

1 **Appendix 1E**

2 **Comments from Individuals and**
 3 **Responses**

4 This section contains copies of comment letters from individuals on the Draft
 5 Environmental Impact Statement (EIS) for the Coordinated Long-term Operation
 6 of the Central Valley Project (CVP) and State Water Project (SWP). Each
 7 comment in the comment letters was assigned a number, in sequential order. The
 8 numbers were combined with the last name of the individual (example: Bartlett
 9 1). The comments with the associated responses are arranged alphabetically by
 10 last name, and appear in the chapter in that order.

11 Copies of the comments are provided in Section 1E.1. Responses to each of the
 12 comments follow the comment letters, and are numbered in accordance with the
 13 numbers assigned in the letters. None of the comments from individuals included
 14 large attachments.

15 **1E.1 Comments and Responses**

16 The individuals listed in Table 1E.1 provided comments on the Draft EIS.

17 **Table 1E.1. Individuals Providing Comments on the Draft Environmental Impact**
 18 **Statement**

Abbreviation	Commenter
Bartlett	John Bartlett
Brobeck 1	James Brobeck
Brobeck 2	James Brobeck
Cardella	Nicolas Cardella
Cartwright	Ken Cartwright
Hoover	Michael Hoover
McDaniel	Daniel McDaniel
St. Amant	Tony St. Amant
Todenhagen	Nora Todenhagen

19
 20

1 **1E.1.1 John Bartlett**

----- Forwarded message -----
From: **John Bartlett** <aufever@gmail.com>
Date: Fri, Jul 31, 2015 at 1:27 PM
Subject: Re; Salmon and Smelt Biologic Opinions
To: bcnelson@usbr.gov

Bartlett 1

The main problem is not with the salmon or smelt, but how the Striped Bass are managed. The California Department of Fish and Game in the past changed the daily limits to lower and the minimum size longer to increase the size and population of Striped Bass, while doing nothing to increase their food supply, so they eat what's available, Salmon Smolts and Delta Smelt. The main problem is the Striped Bass and how DFG manages the fishery. I have fished both coasts and fresh and salt water.

John Bartlett
1574 Bluejay Circle
Hanford, Ca. 93230
aufever@gmail.com

--

Ben Nelson

Natural Resources Specialist

Bureau of Reclamation, Bay-Delta Office

916-414-2424

2

3 **1E.1.1.1 Responses to Comments from John Bartlett**

4 **Bartlett 1:** Two of the alternatives evaluated in the EIS, Alternatives 3 and 4,
5 included modifications of the striped bass bag limits to reduce the predation
6 potential on native species, as described in Sections 3.4.5.2 and 3.4.6.2 of Chapter
7 3, Description of Alternatives.

8

1 1E.1.2 James Brobeck – Number 1 Comment

091015 Hearing.txt

1

---o0o---

Public Meetings
Draft Environmental Impact Statement
for the Coordinated Long-Term Operation
of the Central Valley Project
and State Water Project

Thursday, September 10, 2015
Red Bluff Community Center
1500 S. Jackson St
Red Bluff, CA 96080
6:00 P.M.

---o0o---

Reported By: Priscilla Steele, CSR No. 14052

♀

2

1

PUBLIC COMMENT SESSION

2

3

JAMES BROBECK: I'm a water policy analyst for

4

Aqualliance; one word with one A in the middle. It's an

Page 1

Brobeck1 1

2

3

Appendix 1E: Comments from Individuals and Responses

091015 Hearing.txt

5 organization.

6 My first comment is that the comment period needs
7 to be extended. This is a voluminous document, and it was
8 not distributed in a timely manner. I've been able to
9 review some of it online, but online is very un-user-
10 friendly as far as searching because it comes in so many
11 segments. And it took over a week to receive one of these
12 CDs in the mail for the entire project. I'm just getting
13 one right now for the first time, leaving me two weeks to
14 review this and compose legitimate comments. So I am
15 asking the Bureau to extend the comment period another 30
16 days and to ask the Court for flexibility in issuing the
17 FEIS and the record of decision, that the artificial
18 deadline for the ROD makes it impossible for the public to
19 fully analyze the alternatives and to compose valid
20 comments. would like to see a 30-day, if not a 60-day
21 extension.

22 I was very concerned that the presentation
23 tonight gave the purpose of the action as what appeared to
24 be maintaining the status quo on water deliveries, in
25 contradiction to the hydrologic reality of the system.

¶

3

1 The presentation disfavored reasonable reductions that
2 would have perhaps protected the fishery, in favor of
3 meeting so-called obligations to deliver water. I say
4 "so-called" because these are not obligations. The Bureau
5 is required to balance the public trust with the desires
6 of the contract of those receiving the water. And the
7 operations of the water projects have been in favor of the
8 contractors, to the disadvantage of the public trust as
9 clearly evidenced by the destruction of the delta smelt,

Page 2

Brobeck1 1
continued

Brobeck1 2

Brobeck1 3

1
2

Appendix 1E: Comments from Individuals and Responses

091015 Hearing.txt
10 the destruction of the salmon in the Sacramento River.
11 I'm outraged that last year's operations wiped
12 out the winter and spring salmon before they spawned. And
13 it appears that mismanagement is going to replicate the
14 destruction of this year's salmon population, leading to a
15 probable extinction of this species.
16 I'm amazed that Alternative 1 and 4 are being
17 presented, the alternatives the contractors sent because
18 they clearly violate the court orders to protect the
19 public trust. I think that this process is invalidated by
20 the failure of the Department of Water Resources to create
21 a CEQA equivalent document. There is no CEQA equivalent
22 document for this project. There needs to be because the
23 State Water Project is integral. This is the coordinated
24 SDWP, State Department of Water Resources. And the CVP is
25 the federal part. So here we are having the feds come up

Brobeck1 3
continued

Brobeck1 4

Brobeck1 5

Brobeck1 6

¶ 4
1 with a draft document, but there is no document to cover
2 the state side of it. There needs to be a sequel
3 equivalent analysis.

4 I'm upset that the Bureau's presentation tonight
5 obfuscated the fact that the lawsuits they cited were
6 lawsuits that were being presented by state water
7 contractors. That obfuscation is unnecessary. It's
8 important to know who is pushing this process. And it's
9 not the public. It's a very small portion of the
10 California population. The state water contractors and
11 settlement contractors were the ones pushing to eliminate
12 the BO and the RPA. The Central Valley Hydrologic model
13 ends in 2003, omitting the most current 12 years. The
14 model is therefore completely inadequate, and any

Brobeck1 7

Brobeck1 8

091015 Hearing.txt

Brobeck 1 8
continued

15 conclusions from the model are as well.
16 NORA TODENHAGEN: My concern with the project and
17 the alternatives is that they are based on what is,
18 really, incomplete data. We don't have a true analysis of
19 the water coming into the systems if we assume
20 continuation of the streams and tributaries, which have
21 been drained due to groundwater extraction.
22 Also, the model on which these decisions or
23 alternatives are based dates only to 2003. So that all of
24 the data information on groundwater and surface water
25 interactions from 2003 to the present has not been used in

‡ 5

1 creating these proposals.
2 JAMES BROBECK: Aqualliance is very concerned
3 that the cumulative impacts to the aquifer system
4 resulting from integrating the groundwater into the state
5 water supply through groundwater substitution water
6 transfers. And continued expansion of
7 groundwater-dependent irrigated agriculture is not being
8 revealed or analyzed. The inevitable de-watering of
9 tributaries and extirpation of groundwater-dependent
10 ecosystems, such as Valley Oak Groves, needs to be
11 revealed and analyzed. For the Bureau to analyze only
12 impacts associated with their demand on the groundwater to
13 facilitate water deliveries throughout the state is
14 unacceptable, if not illegal.

15 (whereupon, the public comment session concluded
16 at 7:45 p.m.)

17
18
19

Page 4

1

2 **1E.1.2.1 Responses to Comments from James Brobeck at the Public**
3 **Meeting held in Red Bluff on September 10, 2015**

4 **Brobeck 1 1:** Comment noted.

5 **Brobeck 1 2:** At the time the request for extension of the public review period
6 was submitted, the Amended Judgement dated September 30, 2014 issued by the
7 United States District Court for the Eastern District of California (District Court)
8 in the *Consolidated Delta Smelt Cases* required Reclamation to issue a Record of
9 Decision by no later than December 1, 2015. Due to this requirement,

1 Reclamation did not have sufficient time to extend the public review period. On
2 October 9, 2015, the District Court granted a very short time extension to address
3 comments received during the public review period, and requires Reclamation to
4 issue a Record of Decision on or before January 12, 2016. This current court
5 ordered schedule does not provide sufficient time for Reclamation to extend the
6 public review period.

7 **Brobeck 1 3:** The purpose of the action, as described in Chapter 2, Purpose and
8 Need, of the EIS, is not biased because it includes a provision to enable
9 Reclamation and DWR to satisfy their contractual obligations to the fullest extent
10 possible in accordance with the authorized purposes of the CVP and SWP, as well as
11 the regulatory limitations on CVP and SWP operations, including applicable state
12 and federal laws and water rights.

13 **Brobeck 1 4:**

14 The population of winter-run Chinook salmon is at extreme risk. NMFS recently
15 named Sacramento River winter-run Chinook salmon as one of the eight species
16 most at-risk of extinction in the near future. Last year (2014), due to a lack of
17 ability to regulate water temperatures in the Sacramento River in September and
18 October, water temperature rose to greater than 60°F. This reduced early life
19 stage survival (eggs and fry) from Keswick to Red Bluff from a recent average of
20 approximately 27 percent (egg-to-fry survival estimates averaged 26.4 percent for
21 winter-run Chinook salmon in 2002-2012) down to 5 percent in 2014.

22 Consequently, 95 percent of the year class of wild winter-run Chinook was lost
23 last year. Additional information regarding key components of the 2015 Shasta
24 Temperature Management Plan is provided at:
25 [http://www.usbr.gov/mp/drought/docs/shasta-temp-mgmt-plan-key-components-](http://www.usbr.gov/mp/drought/docs/shasta-temp-mgmt-plan-key-components-06-18-15.pdf)
26 [06-18-15.pdf](http://www.usbr.gov/mp/drought/docs/shasta-temp-mgmt-plan-key-components-06-18-15.pdf).

27 The 2014 spawning run of spring-run Chinook salmon returning to the upper
28 Sacramento River system also experienced significant impacts due to drought
29 conditions as well as elevated temperatures on the Sacramento River and other
30 tributaries. Similar to winter-run, spring-run eggs in the Sacramento River
31 experienced significant and potentially complete mortality due to high water
32 temperatures downstream of Keswick Dam starting in early September 2014
33 when water temperatures exceeded 56° F. Extremely few juvenile spring-run
34 Chinook salmon were observed this year migrating downstream of the
35 Sacramento River during high winter flows, when spring-run originating from the
36 upper Sacramento River, Clear Creek, and other northern tributaries are typically
37 observed, indicating that the population was significantly impacted. Similar
38 concerns for spring-run exist this year as for winter-run. While spring-run have
39 greater distribution and inhabit locations in addition to the Sacramento River,
40 conditions on those streams are also expected to be poor due to the drought. The
41 conservation of storage expected as a result of the changes requested in the
42 Temporary Urgency Change (TUC) Permit submitted by Reclamation and DWR
43 in response to drought conditions are expected to also benefit spring-run this year.
44 Additional information regarding CVP and SWP operations under a TUC Order
45 issued on July 3, 2015, by the State Water Resources Control Board is provided

1 at:
2 http://www.waterboards.ca.gov/waterrights/water_issues/programs/drought/docs/tucp/2015/tucp_order070315.pdf.

4 **Brobeck 1 5:** Alternatives 1 through 4 were selected as part of the range of
5 alternatives evaluated in the EIS, as described in Section 3.4 of Chapter 3,
6 Description of Alternatives. The commenter’s opposition to Alternatives 1
7 through 4 is acknowledged.

8 **Brobeck 1 6:** The District Court required Reclamation to prepare a NEPA
9 document upon the provisional acceptance of the RPA actions in the 2008
10 USFWS BO and 2009 NMFS BO. Reclamation is the lead agency for this action
11 and the environmental document; therefore, the environmental document is being
12 prepared only under the National Environmental Policy Act. Several State of
13 California agencies are cooperating agencies for this EIS. Because compliance
14 with the California Environmental Quality Act (CEQA) would be under DWR’s
15 purview, Reclamation consulted with DWR on this comment. On October 5,
16 2015, DWR provided the following response: “The District Court required
17 Reclamation to comply with NEPA on the provisional acceptance of the RPA
18 actions. There is no action for the State of California requiring California
19 Environmental Quality Act (CEQA) review.”

20 **Brobeck 1 7:** Recent ESA consultation activities and court rulings are discussed
21 in Section 1.2.3.2 of Chapter 1, Introduction, of the EIS.

22 **Brobeck 1 8:** The CVHM model was used to support the EIS groundwater
23 program because it was deemed to have the greatest resolution (vertically and
24 spatially) and more robust calibration than any of the other available Central-
25 Valley wide models. While the CVHM model simulation period ends at the end
26 of 2003, none of the Central-Valley wide models that simulate groundwater
27 conditions for more recent periods post-2003 were available or deemed adequate
28 for the analysis at the time of preparation of the EIS. The 1961 through 2003 time
29 period simulated by CVHM includes varying hydrologic conditions that range
30 from extreme dry periods (such as 1987-92) and extreme wet periods (1983).

31

1 **1E.1.3 James Brobeck – Number 2 Comment**

091015 Hearing.txt

1

---o0o---

Public Meetings
Draft Environmental Impact Statement
for the Coordinated Long-Term Operation
of the Central Valley Project
and State Water Project

Thursday, September 10, 2015
Red Bluff Community Center
1500 S. Jackson St
Red Bluff, CA 96080
6:00 P.M.

---o0o---

Reported By: Priscilla Steele, CSR No. 14052

2

2 JAMES BROBECK: Aqualliance is very concerned
3 that the cumulative impacts to the aquifer system
4 resulting from integrating the groundwater into the state
5 water supply through groundwater substitution water
6 transfers. And continued expansion of
7 groundwater-dependent irrigated agriculture is not being
8 revealed or analyzed. The inevitable de-watering of
9 tributaries and extirpation of groundwater-dependent
10 ecosystems, such as valley oak groves, needs to be
11 revealed and analyzed. For the Bureau to analyze only
12 impacts associated with their demand on the groundwater to
13 facilitate water deliveries throughout the state is
14 unacceptable, if not illegal.

15 (whereupon, the public comment session concluded
16 at 7:45 p.m.)

17
18
19

Brobeck2 1

3

1 **1E.1.3.1 Responses to Comments from James Brobeck at the Public**
2 **Meeting held in Red Bluff on September 10, 2015**

3 **Brobeck 2 1:** The cumulative effects analysis discussion in Chapter 7,
4 Groundwater Resources and Groundwater Quality, has been modified to provide
5 more discussion of the potential effects of future projects.

6
7
8

1 **1E.1.4 Nicolas Cardella**

----- Forwarded message -----

From: Nicolas Cardella <ncardella@prlawcorp.com>

Date: Tue, Sep 22, 2015 at 5:05 PM

Subject: Question re Draft EIS for Coordinated Long-Term Operation of the CVP and SWP

To: bcnelson@usbr.gov

Cc: Alex Peltzer <apeltzer@prlawcorp.com>

Mr. Nelson:

Cardella 1

My name is Nicolas Cardella. We met at the Draft EIS presentation in Los Banos and I promised to write you a letter thanking you for all your hard work on the Draft EIS on condition that it be framed and prominently displayed in the Bay-Delta office. I would like to take this opportunity to assure you that I have not forgotten my promise. Regrettably, however, this is not that letter. For now, I have a question regarding the Draft EIS that I was hoping you could help me with.

Cardella 2

Chapter 5 shows the changes in CVP water deliveries under the Alternatives as compared to the No Action Alternative and the Second Basis of Comparison. For each comparison, the San Joaquin River Exchange Contractors, which are described as a "South of Delta" contractor, are shown to experience no change in CVP water deliveries. See Table 5.26 (5-93), 5.43 (5-122), 5.60 (5-150), 5.77 (5-176), 5.94 (5-203), 5.111 (5-231). My understanding is that the Exchange Contractors ordinarily receive water from the Delta but can, under certain circumstances, receive water from the San Joaquin and Kings Rivers. So my question is this: Are these tables saying that there would be no change to the Exchange Contractors' deliveries *from the Delta*, or that there would be no change to the Exchange Contractors' water deliveries *from all available sources*?

My concern is whether there has been some consideration of impacts to other CVP contractors resulting from the Exchange Contractors receipt of water from the San Joaquin and Kings Rivers, rather than the Delta.

Best,
Nic

Nicolas R. Cardella
Peltzer & Richardson LC
100 Willow Plaza, Suite 309, Visalia, CA 93291

P: 559-358-2713

E: ncardella@prlawcorp.com

CONFIDENTIALITY NOTICE: This communication and any accompanying document(s) are privileged and confidential, and are intended for the sole use of the addressee(s). If you have received this transmission in error, you are advised that any disclosure, copying, distribution, or the taking of any action in reliance upon it is strictly prohibited. Moreover, any such inadvertent disclosure shall not compromise or waive the attorney-client privilege as to this communication or otherwise. If you have received this communication in error, please immediately delete it and contact the above sender. Thank you.

2

3 **1E.1.4.1 Responses to Comments from Nicolas Cardella**

4 **Cardella 1:** Comment noted.

5 **Cardella 2:** The EIS analysis assumes all water deliveries to the San Joaquin
6 River Exchange Contractors are conveyed through the Delta; and water deliveries
7 from Millerton Lake would be similar under all alternatives and the Second Basis
8 of Comparison in all water year types. However, it is recognized that during
9 extreme droughts, water can be delivered to the San Joaquin River Exchange
10 Contractors from Millerton Lake and CVP deliveries to users along the Friant and
11 Madera canals can be reduced. Droughts have occurred throughout California's
12 history, and are constantly shaping and innovating the ways in which Reclamation
13 and DWR balance both public health standards and urban and agricultural water
14 demands while protecting the Delta ecosystem and its inhabitants. The most
15 notable droughts in recent history are the droughts that occurred in 1976-77,
16 1987-92, and the ongoing drought. More details have been included in Section

Appendix 1E: Comments from Individuals and Responses

1 5.3.3 of Chapter 5, Surface Water Resources and Water Supplies, in the Final EIS
2 to describe historical responses by CVP and SWP to these drought conditions,
3 including recent deliveries of CVP water to the San Joaquin River Exchange
4 Contractors.

5

6

1 **1E.1.5 Ken Cartwright**

To-Bureau of Reclamation

Subject: "Biological opinions"

Cartwright 1

The opinions are designed to keep water away from the farmers in the valley, the environmentalist could care less about the salmon or smelt, that's the tool they use to keep water away from farmers.

to solve the water problem in Calif, hang the environmentalist and the fight for water is over. The environ have put thousands of people out of work and could less.

Ken Cartwright
168 maple way
Hanford Ca. 93230

916-414-2439

2

3 **1E.1.5.1 Responses to Comments from Ken Cartwright**

4 **Cartwright 1:** Commenter's opposition to the biological opinions is noted. The
5 EIS alternatives presented in Chapter 3, Description of Alternatives, represent a
6 range of operations that result in different amounts of water for use by municipal,
7 agricultural, and environmental beneficial uses in the CVP and SWP service areas
8 and in water bodies affected by CVP and SWP operations.

9

Appendix 1E: Comments from Individuals and Responses

1 **1E.1.6 Michael Hoover**

9/3/2015

DEPARTMENT OF THE INTERIOR Mail - Re: Comment for Reclamation



Nelson, Benjamin <bcnelson@usbr.gov>

Re: Comment for Reclamation

Sierzputowski, Janet <jsierzputowski@usbr.gov> Mon, Aug 3, 2015 at 3:40 PM
To: mh Hoover27@comcast.net
Cc: Janet Sierzputowski <JSierzputowski@usbr.gov>, Benjamin Nelson <bcnelson@usbr.gov>

Good afternoon, Mr. Hoover.

Thank you very much for your email and for your close attention to detail as you were reading the article in the Hanford Sentinel. We will contact the newspaper and request a correction. Please note that the paper is not obliged to actually make the requested correction, but hopefully they will.

Sincerely, Janet 08/03/15

Janet Sierzputowski, Public Affairs Specialist
Bureau of Reclamation, Mid-Pacific Region
2800 Cottage Way, MP-140, Sacramento, CA 95825
Office 916-978-5112, Cell 916-943-6944

From Michael Hoover (mhoover27@comcast.net) on 08/03/2015 at 01:08:38MSGBODY:
Please note the following misinformation provided by the Hanford Sentinel:

Hoover 1

Feds seek input on salmon, smelt 'biological opinions' – The federal Bureau of Reclamation wants public input on two fish "biological" opinions that affect the agricultural and municipal water supply coming from the Central Valley Project and the State Water Project. http://hanfordsentinel.com/news/local/fed-seek-input-on-salmon-smelt-biological-opinions/article_6fb7718d-423c-5398-99fe-675a30524995.html

Agencies request public comment on their analyses as provided in a NEPA document prior to any associated decision, not on the validity of Biological Opinions as required by law. This is a legal issue that should be discussed with your Solicitor and clarified for and in the Hanford Sentinel.

Previous Page: <http://www.usbr.gov/main/comments.cfm>

2

3 **1E.1.6.1 Responses to Comments from Michael Hoover**

4 **Hoover 1:** Comment noted.

5

1 **1E.1.7 Daniel McDaniel**

**Daniel A. McDaniel
Post Office Box 1461
Stockton, California 95201**

September 29, 2015

**Via Email bcnelson@usbr.gov
and First Class Mail**

Ben Nelson
Bay-Delta Office
U.S. Bureau of Reclamation
801 I Street, Suite 140
Sacramento, Ca 95814-2536

Re: Draft Environmental Impact Statement for the
Coordinated Long-Term Operation of the Central Valley Project
and State Water Project

Dear Mr. Nelson:

Please accept these comments on the Draft Environmental Impact Statement for the Coordinated Long-Term Operation of the Central Valley Project and State Water Project ("DEIS").

I have lived, worked, and recreated in the Delta region for my entire life. My family settled in the Central Valley in the 1800's. I have a special attachment to the Delta as a place. The lands and waterways within the Delta are dedicated to a multitude of uses, including agricultural, residential, recreational, environmental, and various commercial uses. The Delta is a home to over a half million people, with an annual economic output in excess of \$26 billion per year as of 2008, and a multitude of species.

I am uniquely qualified to comment on the DEIS, since I have witnessed the Delta suffer the consequences of excessive state and federal project diversions and exports from the Delta, which are increased due to the coordinated operations of the state and federal projects. I recall when the Delta was a much healthier place when I was a child, in the 1950's.

McDaniel

1

2

3

Ben Nelson
September 29, 2015
Page 2

1. The Alternatives Should Include Independent Project Operation Without Coordinated Operations.

The most obvious alternative, operation of the projects without coordination, appears to have been overlooked or avoided. Operations without coordination would provide the only real alternative which could avoid the application of the biological opinions. The DEIS should have analyzed the separate operations of the projects without any coordination, and analyzed those operations as against the need for coordinated operations under the requirements imposed by the biological opinions. In particular, increased instream flows in the Delta in the absence of coordinated operations should be analyzed.

McDaniel
2

McDaniel
3

2. Failure to evaluate the project and all alternatives for consistency and compliance with the CVPIA.

The CVPIA provides a clear mandate in section 3406(b) to the Bureau to conform its operations with all obligations under state and federal laws in effect at the time of enactment in 1992. That section also includes the fish doubling goal.

McDaniel
4

The DEIS should include an analysis of how operations will achieve and enable compliance with the CVPIA, including but not limited to the doubling goals for all anadromous fish as specifically defined by the CVPIA to include Striped Bass and American Shad. The Anadromous Fish Restoration Program established a doubling goal for Striped Bass of 2,500,000 fish. The deadline for achieving that has long passed, yet Striped Bass are in catastrophic decline. The DEIS fails to mention any meaningful efforts being made to achieve the doubling goal, despite being 14 years overdue. The DEIS should evaluate the project and the alternatives for consistency and compliance with all CVPIA obligations, and all CVPIA objectives and goals.

3. Failure to Determine, Consider, Evaluate, and Mitigate Predation on Striped Bass.

As Striped Bass are an important sport fishing asset entitled to special attention and protection under the CVPIA, predation on Striped Bass by other species should be analyzed considered, evaluated and mitigated against. The DEIS notes the importance to Striped Bass of the salinity gradient and predation upon other species, but fails to consider predation upon Striped Bass by mammals, birds, and other fish. Further, the DEIS fails to analyze and to consider mitigation of salinity impacts on Striped Bass.


McDaniel
5

McDaniel
6

Ben Nelson
September 29, 2015
Page 3

Thank you for the opportunity to comment on the DEIS. We look forward to the receipt of a revised DEIS.

Very truly yours,



DANIEL A. MCDANIEL

1

2 **1E.1.7.1 Responses to Comments from Daniel McDaniel**

3 **McDaniel 1:** Comment noted.

4 **McDaniel 2:** As described in Section 3.3.1 of Chapter 3, Description of
5 Alternatives, in the EIS, Reclamation and California Department of Water
6 Resources (DWR) are required to operate the CVP and SWP, respectively, in a
7 coordinated manner under the conditions of the Coordinated Operations
8 Agreement (COA). This agreement was signed by the United States Congress
9 and the California Legislature in 1986 to define operational procedures and
10 formulas to share joint responsibilities for meeting Delta standards and other legal
11 uses of water in the Delta watershed. Therefore, all alternatives must include the
12 coordinated long-term operation of the CVP and SWP.

13 **McDaniel 3:** Operations under the range of EIS alternatives result in a range of
14 Delta inflows and Delta outflows, as shown in Figures 5.59 through 5.61
15 (Sacramento River at Freeport) and Figures 5.74 through 5.76 (Delta outflow) of
16 Chapter 5, Surface Water Resources and Water Supplies. Additional details are
17 provided in Appendix 5A, Section C, CalSim II and DSM2 Model Results.

18 **McDaniel 4:** A footnote has been added to Table 9.1 in Chapter 9, Fish and
19 Aquatic Resources, of the EIS, to identify the fish species that are a focus of
20 Section 3406(b)(1) of the Central Valley Project Improvement Act. Additional
21 text also has been added in the impact assessment sections of Chapter 9 to
22 indicate that increased bag limits for striped bass under Alternatives 3 and 4 could
23 affect the ability to meet Section 3406(b)(1) goals for striped bass.

24 **McDaniel 5:** The continued operation of the CVP and SWP would not result in
25 changes to land use or levees with terrestrial resources that support mammals,
26 birds, and amphibians that prey upon striped bass during some of their life stages.
27 Therefore, these terrestrial resources in relation to striped bass were not described
28 in detail in the EIS because there would be no changes between the alternatives.

29 **McDaniel 6:** As described in Section 9.3.4.4.1 of Chapter 9, Fish and Aquatic
30 Resources, of the EIS, most Striped Bass spawning occurs upstream of the salinity
31 zone, and the adult Striped Bass move into the brackish and salt water of the Delta
32 and San Francisco Bay in the summer and fall. Changes in the salinity zone
33 between the alternatives are most evident in the fall months with smaller changes

Appendix 1E: Comments from Individuals and Responses

1 in April and May based upon conditions under the No Action Alternative and
2 Alternatives 2 and 5, as compared to conditions under Alternatives 1, 3, and 4, as
3 shown in the location of X2 (see Figures conditions C-16.2.1 through 16.2.6 of
4 Appendix 5A, Section C, CalSim II and DSM2 Model Results).
5 The text has been modified in Section 9.4 of Chapter 9, Fish and Aquatic
6 Resources, in the Final EIS to address the relationship of salinity gradients and
7 abundance of Striped Bass.
8
9

1 **1E.1.8 Tony St. Amant**

From: Tony St. Amant <tsainta@hotmail.com>
Date: Fri, Sep 18, 2015 at 1:40 PM
Subject: DEIS Extension
To: benelson@usbr.gov

Dear Mr.Nelson,

St. Amant 1

Please extend for 30 days the comment period for the Bureau of Reclamation's Coordinated Long-Term Operation of the Central Valley Project and State Water Project Draft Environmental Impact Statement (DEIS). This is a particularly complicated topic and with the concurrent comment period on the DEIS/EIR for the California Water Fix (formerly BDCP), additional time to review this project is needed.

Tony St. Amant

Chico

Thanks,

--

Ben Nelson

Natural Resources Specialist

Bureau of Reclamation, Bay-Delta Office

916-414-2424

2

3 **1E.1.8.1 Responses to Comments from Tony St. Amant**

4 **St. Amant 1:** At the time the request for extension of the public review period
5 was submitted, the Amended Judgement dated September 30, 2014 issued by the
6 United States District Court for the Eastern District of California (District Court)
7 in the *Consolidated Delta Smelt Cases* required Reclamation to issue a Record of
8 Decision by no later than December 1, 2015. Due to this requirement,
9 Reclamation did not have sufficient time to extend the public review period. On
10 October 9, 2015, the District Court granted a very short time extension to address
11 comments received during the public review period, and requires Reclamation to
12 issue a Record of Decision on or before January 12, 2016. This current court
13 ordered schedule does not provide sufficient time for Reclamation to extend the
14 public review period.

15

1 **1E.1.9 Nora Todenhagen**

091015 Hearing.txt

1

---o0o---

Public Meetings
Draft Environmental Impact Statement
for the Coordinated Long-Term Operation
of the Central Valley Project
and State Water Project

Thursday, September 10, 2015
Red Bluff Community Center
1500 S. Jackson St
Red Bluff, CA 96080
6:00 P.M.

---o0o---

Reported By: Priscilla Steele, CSR No. 14052

2

16 NORA TODENHAGEN: My concern with the project and
17 the alternatives is that they are based on what is,
18 really, incomplete data. We don't have a true analysis of
19 the water coming into the systems if we assume
20 continuation of the streams and tributaries, which have
21 been drained due to groundwater extraction.
22 Also, the model on which these decisions or
23 alternatives are based dates only to 2003. So that all of
24 the data information on groundwater and surface water
25 interactions from 2003 to the present has not been used in

Togenhagen 1

♀

5

3

1 creating these proposals.

4

5 **1E.1.9.1 Responses to Comments from Nora Todenhagen at the Public**
6 **Meeting held in Red Bluff on September 10, 2015**

7 **Todenhagen 1:** The CVHM model was used to support the EIS groundwater
8 program because it was deemed to have the greatest resolution (vertically and
9 spatially) and more robust calibration than any of the other available Central-
10 Valley wide models. While the CVHM model simulation period ends at the end

1 of 2003, none of the Central-Valley wide models that simulate groundwater
2 conditions for more recent periods post-2003 were available or deemed adequate
3 for the analysis at the time of preparation of the EIS. The 1961 through 2003 time
4 period simulated by CVHM includes varying hydrologic conditions that range
5 from extreme dry periods (such as 1987-92) and extreme wet periods (such as
6 1983).

7

8

9

1 **Appendix 3A**

2 **No Action Alternative: Central Valley**
3 **Project and State Water Project**
4 **Operations**

5 **3A.1 Overview of the Central Valley Project and State**
6 **Water Project**

7 The Central Valley Project (CVP), operated by Bureau of Reclamation
8 (Reclamation), and the State Water Project (SWP), operated by the California
9 Department of Water Resources (DWR), are major interbasin water storage and
10 delivery systems that divert water from the Sacramento River and San Joaquin
11 River watersheds. These facilities also divert water from the southern portion of
12 the Sacramento–San Joaquin River Delta (Delta) to areas located south and west
13 of the Delta. Their operations store water, and divert and re-divert CVP and/or
14 SWP water that has been stored in upstream reservoirs. The CVP and SWP
15 operate pursuant to water right permits and licenses issued by the State Water
16 Resources Control Board (SWRCB). These permits and licenses allow for
17 appropriation of specific quantities of water for diversion to storage, releases from
18 that storage later in the year, and/or direct diversion. As conditions of the water
19 right permits and licenses, the CVP and SWP are required by SWRCB to meet
20 specific water quality objectives. As a result, Reclamation and DWR closely
21 coordinate CVP and SWP operations to meet these conditions.

22 The CVP was originally authorized by the Rivers and Harbors Act of 1935. It
23 was reauthorized by the Rivers and Harbors Act of 1937 and again by the Central
24 Valley Project Improvement Act (CVPIA) in 1992. The CVP is composed of
25 nine divisions: Shasta and Trinity River Divisions, Sacramento River Division,
26 American River Division, Delta Division, East Side Division, West San Joaquin
27 Division, Friant Division, and the San Felipe Division. The CVP is composed of
28 some 18 reservoirs with a combined storage capacity of more than 11 million
29 acre-feet (MAF), 11 power plants, and more than 500 miles of major canals and
30 aqueducts. These various facilities are generally operated as an integrated project,
31 although they are authorized and categorized in divisions. Authorized project
32 purposes include river regulation; flood control; navigation; provision of water for
33 irrigation and domestic uses; fish and wildlife mitigation, protection, restoration,
34 and enhancement; and power generation. However, not all facilities are operated
35 to meet all of these purposes. As initially authorized, the primary CVP purpose
36 was to provide water for irrigation throughout California’s Central Valley. The
37 CVPIA has amended CVP authorizations to include fish and wildlife mitigation,
38 protection, and restoration; domestic uses; fish and wildlife enhancement; and
39 power generation. The CVP’s major storage facilities are Shasta Lake, Trinity

1 Lake, Folsom Reservoir, and New Melones Reservoir. The upstream reservoirs
2 release water for delivery to in-basin users, flows in Delta tributaries to meet
3 Delta water quality objectives and outflow criteria, and for delivery of CVP water
4 through the C.W. Jones Pumping Plant (Jones Pumping Plant) to storage in San
5 Luis Reservoir (jointly operated by Reclamation and DWR) or delivery through
6 the Delta Mendota Canal (DMC).

7 The Burns-Porter Act, approved by the California voters in November 1960
8 (Water Code Sec. 12930-12944), authorized issuance of bonds for construction of
9 the SWP. The principal facilities of the SWP are Oroville Reservoir and related
10 facilities, San Luis Dam and related facilities, Delta facilities, the California
11 Aqueduct, and North and South Bay Aqueducts. The SWP stores and distributes
12 water for agricultural and municipal and industrial (M&I) uses in the northern
13 Central Valley, the San Francisco Bay area, the San Joaquin Valley, the Central
14 Coast, and Southern California. Other project functions include flood control,
15 water quality maintenance, power generation, recreation, and fish and wildlife
16 enhancement. In general, water is released from storage facilities for delivery to
17 in-basin users, into Delta tributaries to meet Delta water quality objectives and
18 outflow criteria, and for delivery of SWP water through the Harvey O. Banks
19 Pumping Plant (Banks Pumping Plant) to storage in San Luis Reservoir or
20 delivery through the California Aqueduct.

21 **3A.2 Coordinated Operation of the Central Valley** 22 **Project and State Water Project**

23 The CVP and SWP are operated in accordance with the Coordinated Operation
24 Agreement adopted by the Federal and state government and water rights permits
25 issued by the SWRCB.

26 **3A.2.1 Coordinated Operation Agreement**

27 Reclamation and DWR have built water storage and water delivery facilities in
28 the Central Valley in order to deliver water to CVP and SWP (Project)
29 contractors, including senior water rights holders. Reclamation and DWR water
30 rights are conditioned by SWRCB to protect the beneficial uses of water within
31 the CVP and SWP and jointly for the protection of beneficial uses in the
32 Sacramento Valley and the Sacramento–San Joaquin Delta Estuary. Reclamation
33 and DWR coordinate and operate the CVP and SWP to meet water right and
34 contract obligations upstream of the Delta, Delta water quality objectives, and
35 CVP and SWP water right and contract obligations that depend upon diversions
36 from the Delta.

37 The Coordinated Operation Agreement (COA), signed in 1986, defines the project
38 facilities and their water supplies, coordinates operational procedures, identifies
39 formulas for sharing joint responsibilities for meeting Delta standards (as the
40 standards existed in SWRCB Water Right Decision 1485 [D-1485]) and other
41 legal uses of water, identifies how unstored flow would be shared, establishes a

1 framework for exchange of water and services between the CVP and SWP, and
2 provides for periodic review of the agreement. DWR and Reclamation have
3 operational arrangements to accommodate new facilities, water quality and flow
4 objectives, the CVPIA, and Federal Endangered Species Act (ESA), but the COA
5 has not been formally modified.

6 **3A.2.1.1 Obligations for In-Basin Uses**

7 In-basin uses are defined in the COA as legal uses of water in the Sacramento
8 Basin, including the water required under the SWRCB Decision 1485 (D-1485)
9 Delta standards (D-1485 ordered the CVP and SWP to guarantee certain
10 conditions for water quality for agricultural, M&I, and fish and wildlife beneficial
11 uses). Each project is obligated to ensure water is available for these uses, but the
12 degree of obligation is dependent on several factors and changes throughout the
13 year, as described below.

14 Balanced water conditions are defined in the COA as periods when it is mutually
15 agreed that releases from upstream reservoirs plus unregulated flows
16 approximately equals the water supply needed to meet Sacramento Valley in-
17 basin uses plus exports. Excess water conditions are periods when it is mutually
18 agreed that releases from upstream reservoirs plus unregulated flow exceed
19 Sacramento Valley in-basin uses plus exports. Reclamation's Central Valley
20 Operations Office (CVOO) and DWR's SWP Operations Control Office
21 (SWPOCO) jointly decide when balanced or excess water conditions exist.

22 During excess water conditions, sufficient water is available to meet all beneficial
23 needs, and the CVP and SWP are not required to make additional releases. In
24 excess water conditions, water accounting is not required and some of the excess
25 water is available to CVP water contractors, SWP water contractors, and users
26 located upstream of the Delta. However, during balanced water conditions, CVP
27 and SWP share the responsibility in meeting in-basin uses.

28 When water must be withdrawn from reservoir storage to meet in-basin uses,
29 75 percent of the responsibility is borne by the CVP and 25 percent is borne by
30 the SWP. When unstored water is available for export (i.e., Delta exports exceed
31 storage withdrawals while balanced water conditions exist), the sum of CVP
32 stored water, SWP stored water, and the unstored water for export is allocated
33 55/45 to the CVP and SWP, respectively. The percentages and ratios included in
34 the COA were derived from negotiations between Reclamation and DWR for
35 SWRCB D-1485 standards and CVP and SWP annual supplies existing at the
36 time and projected into the future. Reclamation and DWR have continued to
37 apply these ratios as new SWRCB standards and other statutory and regulatory
38 changes have been adopted.

39 **3A.2.1.2 Accounting and Coordination of Operations**

40 Reclamation and DWR coordinate on a daily basis to determine target Delta
41 outflow for water quality, reservoir release levels necessary to meet in-basin
42 demands, schedules for joint use of the San Luis Unit facilities, and for the use of
43 each other's facilities for pumping and wheeling.

1 During balanced water conditions, daily water accounting is maintained for the
2 CVP and SWP obligations. This accounting allows for flexibility in operations
3 and avoids the necessity of daily changes in reservoir releases that originate
4 several days' travel time from the Delta. It also means adjustments can be made
5 "after the fact," using actual observed data rather than by prediction for the
6 variables of reservoir inflow, storage withdrawals, and in-basin uses. This
7 iterative process of observation and adjustment results in a continuous truing up
8 of the running COA account.

9 The accounting language of the COA provides the mechanism for determining the
10 responsibility of each project for Delta outflow influenced standards; however,
11 real-time operations dictate actions. For example, conditions in the Delta can
12 change rapidly. Weather conditions combined with tidal action can quickly affect
13 Delta salinity conditions, and therefore, the Delta outflow required to maintain
14 standards. If, in this circumstance, it is decided the reasonable course of action is
15 to increase upstream reservoir releases, then the response may be to increase
16 Folsom Reservoir releases first because the released water will reach the Delta
17 before flows released from other CVP and SWP reservoirs. Lake Oroville water
18 releases require about 3 days to reach the Delta, while water released from Shasta
19 Lake requires 5 days to travel from Keswick Reservoir to the Delta. As water
20 from the other reservoirs arrives in the Delta, Folsom Reservoir releases can be
21 adjusted downward. Any imbalance in meeting each Project's initial shared
22 obligation would be captured by the COA accounting.

23 Reservoir release changes are one means of adjusting to changing in-basin
24 conditions. Increasing or decreasing project exports can also immediately achieve
25 changes to Delta outflow. As with changes in reservoir releases, imbalances in
26 meeting each project's initial shared obligations are captured by the COA
27 accounting.

28 During periods of balanced water conditions, when real-time operations dictate
29 project actions, an accounting procedure tracks the initial sharing water
30 obligations of the CVP and SWP. The CVP and SWP produce daily and
31 accumulated accounting balances. The account represents the imbalance resulting
32 from actual coordinated operations compared to the initial COA sharing of
33 obligations and supply. The project that is "owed" water (i.e., either CVP or SWP
34 provided more or exported less than its COA-defined share) may request the other
35 Project adjust its operations to reduce or eliminate the accumulated account
36 within a reasonable time.

1 The duration of balanced water conditions varies from year to year. Some very
2 wet years have had no periods of balanced conditions, while very dry years have
3 had long continuous periods of balanced conditions, and still other years may
4 have had several periods of balanced conditions interspersed with excess water
5 conditions. Account balances continue from one balanced water condition
6 through the excess water condition and into the next balanced water condition.
7 When the Project that is owed water enters into flood control operations, Shasta
8 Lake and Folsom Reservoir for the CVP and Lake Oroville for the SWP, the
9 accounting is zeroed out for that Project.

10 **3A.2.1.3 Changes in Coordinated Operation Since 1986**

11 Implementation of the COA principles has continuously evolved since 1986 as
12 changes have occurred to CVP and SWP facilities, to Project operations criteria,
13 and to the overall physical and regulatory environment in which the coordination
14 of CVP and SWP operations takes place. Since 1986, new facilities have been
15 incorporated into the operations that were not part of the original COA. New
16 water quality objectives (SWRCB Water Quality Control Plan [WQCP] for the
17 Bay-Delta in 1995 and 2006, as implemented through Water Right Decision 1641
18 [D-1641]) have been adopted by SWRCB; the CVPIA has changed how the CVP
19 is operated; and finally, ESA responsibilities have affected both the CVP and
20 SWP operations. The following describes the significant changes that have
21 occurred since 1986. Included after each item is an explanation of how it relates
22 to the COA and its general effect on the accomplishments of the Projects.

23 **3A.2.1.3.1 Sacramento River Temperature Control Operations**

24 Water temperature control operations have changed the pattern of storage and
25 withdrawal of storage at Shasta Lake, Trinity Lake, and Whiskeytown Reservoir,
26 for the purpose of improving temperature control and managing coldwater pool
27 resources in the facilities. Water temperature operations have also constrained
28 rates of flow and changes in rates of flow below Keswick Dam, in keeping with
29 water temperature requirements. Such constraints have reduced the CVP's ability
30 to respond efficiently to changes in Delta export or outflow requirements.
31 Periodically, temperature requirements have caused the timing of the CVP
32 releases to be significantly mismatched with Delta export capability, resulting in
33 loss of water supply. The installation of a Shasta Lake temperature control device
34 has significantly improved Reclamation's ability to match reservoir releases and
35 Delta needs.

36 **3A.2.1.3.2 Bay-Delta Accord, and Subsequent SWRCB Implementation** 37 **of D-1641**

38 The 1994 Bay-Delta Accord committed the CVP and SWP to a set of Delta
39 habitat-protective objectives that were eventually incorporated into the
40 1995 Bay-Delta Water Quality Control Plan (WQCP), and later, along with the
41 temporary Vernalis Adaptive Management Plan (VAMP) (since expired), were
42 implemented through SWRCB D-1641 which amended the water rights of the

1 Projects. The actions taken by the CVP and SWP in implementing SWRCB
2 D-1641 significantly reduced the export water supply of both Projects.
3 As described previously, Project operators must coordinate the day-to-day
4 operations of the CVP and SWP to comply with the Projects' water right permits.
5 The 1986 COA sharing formula has been used by Project operators for
6 SWRCB D-1641 Delta outflow and salinity-based standards. SWRCB D-1641
7 contains significant new "export limitation" criteria such as the export to inflow
8 (E/I) ratios. The 1986 COA framework neither contemplated nor addressed the
9 application of such criteria to CVP and SWP permits. In most cases, when the E/I
10 restrictions control Project operations, operators attempt is made to even out the
11 rate of export over the restricted period. In some cases, a seasonal time shift of
12 the SWP exports can help facilitate an equitable sharing of responsibilities. Until
13 the COA is updated to reflect SWRCB D-1641 conditions, Project operators must
14 continually work on a case-by-case basis in order to meet the Projects' water right
15 requirements.

16 **3A.2.1.3.3 North Bay Aqueduct**

17 The North Bay Aqueduct (NBA) is a SWP feature that can convey up to about
18 175 cubic feet per second (cfs) diverted from the SWP's Barker Slough Pumping
19 Plant. NBA diversions are conveyed to SWP water contractors in Napa and
20 Solano Counties. The diversion is currently treated as an in-basin demand shared
21 by both Projects.

22 **3A.2.1.3.4 Freeport Regional Water Project**

23 The Freeport Regional Water Project is a new facility that diverts up to a
24 maximum of 286 cfs from the Sacramento River near Freeport for use in
25 Sacramento County and by East Bay Municipal Utility District (EBMUD).
26 EBMUD diverts water pursuant to its amended contract with Reclamation. The
27 County diverts under their water rights and a CVP water service contract supply.
28 This facility was not in the 1986 COA, and the diversions result in an increase of
29 in-basin demands. The diversion is currently treated as an in-basin demand
30 shared by both Projects.

31 **3A.2.1.3.5 Loss of 195,000 Acre-Feet of D-1485 Condition 3** 32 **Replacement Pumping**

33 The 1986 COA affirmed the SWP's commitment to provide replacement capacity
34 at Banks Pumping Plant to the CVP at times when it would not reduce SWP yield,
35 to make up for May and June pumping reductions at Jones Pumping Plant as
36 imposed by striped bass protections under SWRCB D-1485 in 1978. In the
37 evolution of COA operations since 1986, SWRCB D-1485 was superseded by
38 SWRCB D-1641, and SWP water demand growth and other pumping constraints
39 have reduced the available surplus capacity at Banks Pumping Plant. The CVP
40 has not received replacement pumping since 1993. Since then there have been
41 (and in the current operations environment there will continue to be) many years
42 in which the CVP would be limited by insufficient Delta export capacity to

1 convey its water supply. The loss of up to 195,000 acre-feet of replacement
2 pumping capacity has diminished the water delivery anticipated by the CVP water
3 users that receive water diverted from the Delta under the 1986 COA framework.
4 The diminished water delivered results in an allocation, or charge, to
5 CVPIA (b)(2) water.

6 **3A.2.2 State Water Resources Control Board Water Rights**

7 **3A.2.2.1 Decision 1641**

8 SWRCB adopted the 1995 WQCP on May 22, 1995, which was implemented, in
9 part, through the SWRCB D-1641. SWRCB D-1641 (adopted on December 29,
10 1999 and revised on March 15, 2000) amends certain terms and conditions of the
11 SWP and CVP water rights to impose flow and water quality objectives to assure
12 protection of beneficial uses in the Delta and Suisun Marsh. SWRCB also grants
13 conditional changes to points of diversion for each project with SWRCB D-1641.

14 The requirements in SWRCB D-1641 address the standards for fish and wildlife
15 protection, M&I water quality, agricultural water quality, and Suisun Marsh
16 salinity. These objectives include specific outflow requirements throughout the
17 year, specific export limits in the spring, and export limits based on a percentage
18 of estuary inflow throughout the year. The water quality objectives are designed
19 to protect agricultural, M&I, and fishery uses, and vary throughout the year and
20 by the wetness of the year.

21 SWRCB D-1641 also authorizes the SWP and CVP to jointly use each other's
22 points of diversion in the southern Delta, with conditional limitations and required
23 response coordination plans. This is described below in more detail. SWRCB
24 D-1641 modified the Vernalis salinity standard under SWRCB Decision 1422
25 (D-1422) to the corresponding Vernalis salinity objective in the 1995 WQCP.

26 **3A.2.2.2 Joint Points of Diversion**

27 SWRCB D-1641 granted Reclamation and DWR the ability to divert water at
28 either Project's south Delta intakes under certain conditions. The SWRCB
29 conditioned the use of Joint Point of Diversion (JPOD) capabilities based on
30 staged implementation and conditional requirements for each stage of
31 implementation. The stages of JPOD in SWRCB D-1641 are:

- 32 • Stage 1—for water service to Cross Valley contractors, San Joaquin Valley
33 National Cemetery and Musco Family Olive Company, and to recover export
34 reductions taken to benefit fish.
- 35 • Stage 2—for any purpose authorized under the current Project water right
36 permits.
- 37 • Stage 3—for any purpose authorized, up to the physical capacity of the
38 diversion facilities.

39 Each stage of JPOD has regulatory terms and conditions that must be satisfied in
40 order to implement JPOD.

- 1 All stages require a response plan to ensure water levels in the southern Delta
2 would not be lowered to the injury of water users (Water Level Response Plan).
3 All stages also require a response plan to ensure the water quality in the southern
4 and central Delta would not be significantly degraded through operations of the
5 JPOD to the injury of water users in the southern and central Delta.
- 6 Any JPOD diversion that causes the Delta to change from excess to balanced
7 conditions is junior to Contra Costa Water District's (CCWD) water right permits
8 for the Los Vaqueros Project. The SWRCB D-1641 also required that JPOD
9 diversions not result in an upstream shift in the X2 location (where 2 parts per
10 thousand salinity isopleth measured at 1 meter from the channel bottom occurs)
11 west of certain compliance locations.
- 12 Stage 2 has an additional requirement to complete an operations plan that would
13 protect fish and wildlife and other legal users of water. This is commonly known
14 as the Fisheries Response Plan. A Fisheries Response Plan was approved by
15 SWRCB in February 2007.
- 16 Stage 3 has an additional requirement to protect water levels in the southern Delta
17 under the operational conditions of Phase II of the South Delta Improvements
18 Program, along with an updated companion Fisheries Response Plan.
- 19 Reclamation and DWR intend to apply all response plan criteria consistently for
20 JPOD uses as well as water transfer uses.
- 21 In general, JPOD capabilities are used to accomplish four basic CVP and
22 SWP objectives:
- 23 • When wintertime excess pumping capacity becomes available during Delta
24 excess conditions and total CVP and SWP San Luis storage is not projected to
25 fill before the spring pulse flow period, the Project with the deficit in San Luis
26 storage may elect to pursue the use of JPOD capabilities.
 - 27 • When summertime pumping capacity is available at Banks Pumping Plant and
28 CVP reservoir conditions can support additional releases, the CVP may elect
29 to use JPOD capabilities to enhance annual CVP south of Delta water
30 supplies.
 - 31 • When summertime pumping capacity is available at Banks or Jones Pumping
32 Plant to facilitate water transfers, JPOD may be used to further facilitate water
33 transfers.
 - 34 • During certain coordinated CVP and SWP operation scenarios for fishery
35 entrainment management, JPOD may be used to shift CVP and SWP exports
36 to the facility with the least fishery entrainment impact while minimizing
37 export at the facility with the most fishery entrainment impact.

1 **3A.2.2.3 Revisions to the SWRCB Bay-Delta Water Quality Control Plan**

2 SWRCB undertook a proceeding under its water quality authority to amend the
3 WQCP adopted in 1978 and amended in 1991 and in 1995. The SWRCB
4 conducted a series of workshops in 2004 and 2005 to receive information on
5 specific topics addressed in the WQCP.

6 The SWRCB adopted a revised WQCP on December 13, 2006. There were no
7 changes to the Beneficial Uses from the 1995 Plan to the 2006 Plan, nor were any
8 new water quality objectives adopted in the 2006 WQCP. A number of changes
9 were made simply for readability. Consistency changes were also made to
10 assure that sections of the WQCP reflected the current physical condition or
11 current regulation.

12 The SWRCB “is in the process of developing and implementing updates to the
13 WQCP and flow objectives for priority tributaries to the Delta to protect
14 beneficial uses in the Bay-Delta watershed. Phase 1 of this work involves
15 updating San Joaquin River flow and southern Delta water quality requirements
16 included in the WQCP. Phase 2 involves other comprehensive changes to the
17 WQCP to protect beneficial uses not addressed in Phase 1. Phase 3 involves
18 changes to water rights and other measures to implement changes to the WQCP
19 from Phases 1 and 2. Phase 4 involves developing and implementing flow
20 objectives for priority Delta tributaries outside of the WQCP updates” (State
21 Water Resources Control Board 2014).

22 **3A.2.3 2008 U.S. Fish and Wildlife Service and 2009 National**
23 **Marine Fisheries Service Biological Opinions on the**
24 **Coordinated Operation of CVP and SWP**

25 The most recent BOs regarding the long-term coordinated operation of the CVP
26 and SWP were issued by the USFWS and NMFS in 2008 and 2009, respectively.
27 Each BO included a Reasonable and Prudent Alternative (RPA). In December
28 2008, USFWS issued a BO for Delta Smelt and their critical habitat, and
29 Reclamation provisionally accepted and implemented the BO, including the RPA.
30 In June 2009, NMFS issued a new BO for Sacramento River winter-run Chinook
31 Salmon, Central Valley spring-run Chinook Salmon, Central Valley Steelhead,
32 Southern Distinct Population Segment of North American Green Sturgeon, and
33 Southern Resident Killer Whales and their critical habitat, and Reclamation
34 provisionally accepted and implemented the BO, including the RPA. Under the
35 2008 USFWS and 2009 NMFS BOs, CVP and SWP operations include the
36 previous operational requirements of SWRCB D-1641 and additional operational
37 requirements, as described below.

38 **3A.3 Operations Real-Time Decision Making**

39 The goals for real-time decision making to assist fishery management are to
40 minimize adverse effects for listed species while meeting permit requirements and
41 contractual obligations for water deliveries.

1 Real-time decision making is a process that promotes flexible decision making
2 that can be adjusted in the face of uncertainties as outcomes from management
3 actions and other events become better understood. High uncertainty exists
4 regarding real time conditions that can change management decisions on methods
5 to balance operations to meet beneficial uses in 2030.

6 Sources of uncertainty include the following.

- 7 • Hydrologic conditions
- 8 • Ocean conditions
- 9 • Listed species (presence, distribution, habitat, and other factors)
- 10 • Ecological conditions

11 **3A.3.1 Process for Real-Time Decision Making**

12 Decisions regarding CVP and SWP operations to avoid and minimize adverse
13 effects on listed species must consider factors that include public health, safety,
14 and water supply reliability. To facilitate such decisions, Reclamation and DWR
15 (Project Agencies) and the fishery agencies (consisting of USFWS, NMFS, and
16 the California Department of Fish and Wildlife [CDFW]) have developed and
17 refined a set of processes for various fish species to collect data, disseminate
18 information, develop recommendations, make decisions, and provide
19 transparency. This process consists of three types of groups that meet on a
20 recurring basis (Table 3A.1):

- 21 • The management team is made up of management staff from Reclamation,
22 DWR, and the fishery agencies. SWRCB participates in management team
23 meetings.
- 24 • Information teams are teams whose role is to disseminate and coordinate
25 information among agencies and stakeholders.
- 26 • Fisheries and operations technical teams are made up of technical staff from
27 state and Federal agencies.

28 These teams review the most up-to-date data and information on fish status and
29 Delta conditions, and develop recommendations that fishery agencies'
30 management can use in identifying actions to protect listed species.

31 The process to identify actions to protect listed species varies to some degree
32 among species but abides by the following general outline. A Fisheries or
33 Operations Technical Team compiles and assesses current information regarding
34 species, such as stages of reproductive development, geographic distribution,
35 relative abundance, and physical habitat conditions. It then provides a
36 recommendation to the agency with statutory obligation to enforce protection of
37 the species in question. The agency's staff and management reviews the
38 recommendation and uses it as a basis for developing, in cooperation with
39 Reclamation and DWR, a modification of water operations that would minimize
40 adverse effects on listed species by the Projects. If the Project Agencies do not
41 agree with the action, then the fishery agency(ies) would advise the Project

1 Agencies that the water management activity considered may cause harm to the
 2 listed species beyond that contemplated in the existing BO. Certain actions may
 3 require input from the SWRCB to assess impacts to the beneficial uses of the
 4 project water because actions can also affect the Projects' ability to comply with
 5 state water rights. In the event it is not possible or appropriate to refine the action,
 6 given the available resources, the Project Agencies would consult with the fishery
 7 agency(ies). The outcomes of protective actions that are implemented are
 8 monitored and documented, and this information informs future
 9 recommended actions.

10 **Table 3A.1 Real-Time Decision Making Groups**

Team Name	Abbreviation	Composition
Water Operations Management Team	WOMT	Reclamation, DWR, USFWS, NMFS, and CDFW. SWRCB participates
CALFED Bay-Delta Program (CALFED) Ops Group	CALFED Ops Group	Reclamation, DWR (Project Agencies), fishery agencies, SWRCB staff, and the USEPA
Data Assessment Team	DAT	Technical staff members from the Project Agencies and fishery agencies; stakeholders
Operations and Fishery Forum	OFF	Contact persons for their respective agencies or interest groups; works in concert with CALFED Ops Group
B2 Interagency Team	(b)(2)IT	Technical staff members from the Project Agencies
Sacramento River Temperature Task Group	SRTTG	Multiagency group
Smelt Working Group	SWG	USFWS, CDFW, DWR, USEPA, and Reclamation
Delta Condition Team	DCT	Scientists and engineers from the state and federal agencies, water contractors, and environmental groups
Delta Operations Salmonid and Sturgeon	DOSS	Reclamation, DWR, CDFW, USFWS, SWRCB, USGS, USEPA, and NMFS
American River Group	ARG	Reclamation, USFWS, NMFS, CDFW, and the Water Forum
Delta Cross Channel Project Work Team	DCC Project Work Team	Multiagency group
Stanislaus Operations Team	OT	To be developed as part of the New Melones revised plan of operations

1 **3A.3.1.1 *Salmon Decision Process***

2 The Salmon Decision Process is used by the fishery agencies and Project
3 operators to facilitate the often complex coordination issues surrounding Delta
4 Cross Channel (DCC) gate operations and the purposes of fishery protection
5 closures, Delta water quality, and/or export reductions. Inputs such as fish life
6 stage and size development, current hydrologic events, fish indicators (such as the
7 Knight's Landing Catch Index and Sacramento Catch Index), and salvage at the
8 export facilities, as well as current and projected Delta water quality conditions,
9 are used to determine potential DCC closures and/or export reductions. The
10 Salmon Decision Process includes "Indicators of Sensitive Periods for Salmon,"
11 such as hydrologic changes, detection of spring-run salmon or spring-run salmon
12 surrogates at monitoring sites or the salvage facilities, and turbidity increases at
13 monitoring sites, which trigger the Salmon Decision Process. The coordination
14 process has worked well during the recent fall and winter DCC operations and is
15 expected to be used in the present or modified form in the future.

16 **3A.3.2 Groups Involved in Real-Time Decision Making and**
17 **Information Sharing**

18 **3A.3.2.1 *Management Team***

19 The Water Operations Management Team (WOMT) is composed of
20 representatives from Reclamation, DWR, USFWS, NMFS, and CDFW. SWRCB
21 participates in discussions. This management-level team was established to
22 facilitate timely decision-support and decision making at the appropriate level.
23 The WOMT first met in 1999, continues to meet to make management decisions.
24 Although the goal of WOMT is to achieve consensus on decisions, the
25 participating agencies retain their authorized roles and responsibilities.

26 **3A.3.2.2 *Information Teams***

27 **3A.3.2.2.1 CALFED Ops and Subgroups**

28 The CALFED Bay-Delta Program (CALFED) Ops Group consists of the Project
29 Agencies, the fishery agencies, SWRCB staff, U.S. Environmental Protection
30 Agency (USEPA), and stakeholders. The CALFED Ops Group generally meets
31 eight times a year in a public setting so that the agencies can inform each other
32 and stakeholders about current operations of the CVP and SWP, implementation
33 of the CVPIA and state and federal endangered species acts, and additional
34 actions to contribute to the conservation and protection of state- and federally
35 listed species. The CALFED Ops Group held its first public meeting in
36 January 1995, and during the next six years the group developed and refined its
37 process. The CALFED Ops Group has been recognized within SWRCB D-1641,
38 and elsewhere, as one forum for coordination on decisions to exercise certain
39 flexibility that has been incorporated into the Delta standards for protection of
40 beneficial uses (e.g., E/I ratios, and some DCC closures). Several teams were
41 established through the CALFED Ops Group process. These teams are
42 described below.

1 **3A.3.2.2.2 Data Assessment Team**

2 The Data Assessment Team (DAT) consists of technical staff members from the
3 Project Agencies and fishery agencies as well as stakeholders. The DAT meets
4 frequently during the fall, winter, and spring. The purpose of the meetings is to
5 coordinate and disseminate information and data among agencies and
6 stakeholders that is related to water Project operations, hydrology, and fish
7 surveys in the Delta.

8 **3A.3.2.2.3 Operations and Fishery Forum**

9 The Operations and Fishery Forum (OFF) was established as an ad-hoc
10 stakeholder-driven process to disseminate information regarding
11 recommendations and decisions about the operations of the CVP and SWP. OFF
12 members are considered the contact persons for their respective agencies or
13 interest groups when information regarding take of listed species, or other factors
14 or urgent issues need to be addressed by the CALFED Ops Group. Alternatively,
15 the CALFED Ops Group may direct the OFF to develop recommendations on
16 operational responses for issues of concern raised by member agencies.

17 **3A.3.2.3 B2 Interagency Team**

18 The B2 Interagency Team [(b)(2)IT] was established in 1999 in accordance with
19 CVPIA and consists of technical staff members from the Project Agencies.
20 CALFED recognized this group to facilitate coordinated operations. The (b)(2)IT
21 meets weekly to discuss implementation of Section 3406 (b)(2) of the CVPIA,
22 which defines the dedication of CVP water supply for environmental purposes. It
23 communicates with WOMT to ensure coordination with the other operational
24 programs or resource-related aspects of Project operations, including flow and
25 temperature issues.

26 **3A.3.3 Operations and Fisheries Technical Teams**

27 Several fisheries-specific teams have been established to provide guidance and
28 recommendations on current operations (flow and temperature regimes), as well
29 as resource management issues. These teams include the following.

30 **3A.3.3.1 The Sacramento River Temperature Task Group**

31 The Sacramento River Temperature Task Group (SRTTG) is a multiagency group
32 formed pursuant to SWRCB Water Rights Orders 90-5 and 91-1, to assist with
33 improving and stabilizing the Chinook Salmon population in the Sacramento River.
34 Annually, Reclamation develops temperature operation plans for the Shasta and
35 Trinity divisions of the CVP. These plans consider impacts on winter-run and other
36 races of Chinook Salmon and associated Project operations. The SRTTG meets
37 initially in the spring to discuss biological, hydrologic, and operational information,
38 objectives, and alternative operations plans for temperature control. Once the SRTTG
39 has recommended an operation plan for temperature control, Reclamation then
40 submits a report to SWRCB, generally on or before June 1 each year.

41

1 After implementation of the operation plan, the SRTTG may perform additional
2 studies. It holds meetings as needed, typically monthly through the summer and
3 into fall, to develop revisions based on updated biological data, reservoir
4 temperature profiles, and operations data. Updated plans may be needed for
5 summer operations to protect winter-run, or in fall for the fall-run spawning
6 season. If there are any changes in the plan, Reclamation submits a supplemental
7 report to SWRCB.

8 **3A.3.3.2 Smelt Working Group**

9 The Smelt Working Group (SWG) consists of representatives from USFWS,
10 CDFW, DWR, USEPA, and Reclamation. USFWS chairs the group, and a
11 member is assigned by each agency. The SWG evaluates biological and technical
12 issues regarding Delta Smelt and develops recommendations for consideration by
13 USFWS. Since longfin smelt became a state candidate species in 2008, the SWG
14 has also developed recommendations for CDFW to minimize adverse effects on
15 longfin smelt.

16 The SWG compile and interpret the latest near real-time information regarding
17 state- and federally listed smelt, such as stages of development, distribution, and
18 salvage. After evaluating available information, if the SWG members agree that a
19 protection action is warranted, the SWG submit its recommendations in writing to
20 USFWS and CDFW.

21 The SWG may meet at any time at the request of USFWS, but generally meets
22 weekly during the months of January through June, when smelt salvage at the
23 CVP and SWP has occurred historically.

24 **3A.3.3.3 Delta Condition Team**

25 The existing SWG and WOMT advise USFWS on smelt conservation needs and
26 water operations. In addition, a Delta Condition Team (DCT), consisting of
27 scientists and engineers from the state and federal agencies, water contractors, and
28 environmental groups, meet weekly to review the real time operations and Delta
29 conditions, including data from new turbidity monitoring stations and new
30 analytical tools such as the Delta Smelt behavior model. The members of the
31 DCT provide their individual information to the SWG and the Delta Operations
32 Salmonid and Sturgeon (DOSS) workgroup. SWG meet later on the day the DCT
33 meets to assess risks to Delta Smelt based upon Delta conditions and the other
34 factors set forth above. The SWG and individual members of the DCT may
35 provide, in accordance with a process provided by the WOMT, their information
36 to the WOMT for its consideration in developing a recommendation to the Project
37 Agencies for actions to protect Delta Smelt and other listed fish. The WOMT
38 supply information for Project Agencies to consider, including impacts on other
39 species and on water supply.

1 **3A.3.3.4 Delta Operations Salmonid and Sturgeon Workgroup**

2 The DOSS workgroup is a technical team with relevant expertise from
3 Reclamation, DWR, CDFW, USFWS, SWRCB, U.S. Geological Survey (USGS),
4 USEPA, and NMFS that provides advice to WOMT and to NMFS on issues
5 related to fisheries and water resources in the Delta and recommendations on
6 measures to reduce adverse effects of Delta operations of the CVP and SWP to
7 salmonids and Green Sturgeon. The purpose of DOSS is to provide
8 recommendations for real-time management of operations to WOMT and NMFS;
9 annually review Project operations in the Delta and the collected data from the
10 different ongoing monitoring programs; and coordinate with the SWG to
11 maximize benefits to all listed species.

12 **3A.3.3.5 American River Group**

13 In 1996, Reclamation established a working group for the Lower American River,
14 known as the American River Group (ARG). Although open to the public, the
15 ARG meetings generally include representatives from several agencies and
16 organizations with ongoing concerns and interests regarding management of the
17 Lower American River. The formal members of the group are Reclamation,
18 USFWS, NMFS, CDFW, and the Water Forum.

19 The ARG convenes monthly or more frequently if needed, with the purpose of
20 providing fishery updates and reports for Reclamation to help manage operations
21 at Folsom Dam and Reservoir for the protection of fishery resources in the Lower
22 American River, and with consideration of its other intended purposes (e.g., water
23 and power supply).

24 **3A.3.3.6 Delta Cross Channel Project Work Team**

25 The DCC Project Work Team is a multiagency group. Its purpose is to determine
26 and evaluate the effects of DCC gate operations on Delta hydrodynamics, water
27 quality, and fish migration.

28 **3A.4 Central Valley Project**

29 **3A.4.1 Project Management Objectives**

30 Facilities are operated and maintained by local Reclamation area offices, with
31 operations overseen by the CVOO at the Joint Operations Center in Sacramento,
32 California. The CVOO is responsible for recommending CVP operating policy,
33 developing annual operating plans, coordinating CVP operations with the SWP
34 and other entities, establishing CVP-wide standards and procedures, and making
35 day-to-day operating decisions.

36 **3A.4.1.1 Central Valley Project Improvement Act**

37 Public Law 102-575 (Reclamation Projects Authorization and Adjustment Act of
38 1992) was passed on October 30, 1992. Included in the law was Title 34, the
39 Central Valley Project Improvement Act. The CVPIA amended previous
40 authorizations of the CVP to include fish and wildlife protection, restoration, and

1 mitigation as project purposes having equal priority with irrigation and domestic
2 water supply uses, and fish and wildlife enhancement as having an equal priority
3 with power generation. Among the changes mandated by the CVPIA are:

- 4 • Dedicating 800 thousand acre-feet (TAF) annually to fish, wildlife, and
5 habitat restoration
- 6 • Authorizing water transfers outside the CVP service area
- 7 • Facilitating water transfers
- 8 • Implementing an anadromous fish restoration program
- 9 • Creating a restoration fund financed by water and power users
- 10 • Providing for the Shasta Temperature Control Device
- 11 • Implementing fish passage measures at Red Bluff Pumping Plant
- 12 • Calling for planning to increase the CVP yield
- 13 • Mandating firm water supplies for Central Valley wildlife refuges
- 14 • Improving the Tracy Fish Collection Facility (TFCF)
- 15 • Meeting Federal trust responsibility to protect fishery resources
16 (Trinity River)

17 The CVPIA is being implemented as authorized. The Final Programmatic
18 Environmental Impact Statement (PEIS) for the CVPIA analyzed projected
19 conditions in 2022, 30 years from the CVPIA's adoption in 1992. The Final PEIS
20 was released in October 1999 and the CVPIA Record of Decision (ROD) was
21 signed on January 9, 2001. The CVPIA BOs were issued on November 21, 2000.

22 **3A.4.1.1.1 CVPIA Section 3406 (b)(2)**

23 On May 9, 2003, the DOI issued its Decision on Implementation of
24 Section 3406 (b)(2) (Decision) of the CVPIA. Dedication of CVPIA (b)(2) water
25 occurs when Reclamation takes a fish, wildlife or habitat restoration action based
26 on recommendations of USFWS (and in consultation with NMFS and CDFW),
27 pursuant to Section 3406 (b)(2). Dedication and management of CVPIA (b)(2)
28 water may also assist in meeting SWRCB WQCP fishery objectives and helps
29 meet the needs of fish listed under the ESA as threatened or endangered since the
30 enactment of the CVPIA.

31 The Decision describes the means by which the amount of dedicated
32 CVPIA (b)(2) water is determined. Planning and accounting for CVPIA (b)(2)
33 actions are done cooperatively and occur primarily through weekly meetings of
34 the (b)(2)IT. The (b)(2)IT formulates recommendations for implementing
35 upstream and Delta actions with CVP delivery capability. Actions usually take
36 one of two forms—instream flow augmentation below CVP reservoirs or CVP
37 Jones Pumping Plant pumping reductions in the Delta.

1 **3A.4.2 Water Service Contracts, Allocations, and Deliveries**

2 **3A.4.2.1 Water Needs Assessment**

3 Water needs assessments have been performed for each CVP water contractor
4 eligible to participate in the CVP long-term contract renewal process. Water
5 needs assessments confirm a contractor's past beneficial use and determine future
6 CVP water supplies needed to meet the contractor's anticipated future demands.
7 The assessments are based on a common methodology used to determine the
8 amount of CVP water needed to balance a contractor's water demands with
9 available surface and groundwater supplies.

10 **3A.4.2.2 Water Allocation—CVP**

11 In most years, the combination of carryover storage and runoff into CVP
12 reservoirs and the Central Valley is not sufficient to provide the water to meet all
13 CVP contractors' contractual demands. Since 1992, increasing constraints placed
14 on operations by legislative and ESA requirements have removed significant
15 operational flexibility to deliver water to all CVP contractors located both to the
16 north and south of the Delta.

17 The water allocation process for the CVP begins in the fall when preliminary
18 assessments are made of the next year's water supply possibilities, given current
19 storage conditions combined with a range of hydrologic conditions. These
20 preliminary assessments may be refined as the water year progresses. Beginning
21 February 1, forecasts of water year runoff are prepared using precipitation to date,
22 snow water content accumulation, and runoff to date. All of CVP's Sacramento
23 River Settlement water rights contracts and San Joaquin River Exchange contracts
24 require that contractors be informed no later than February 15 of any possible
25 deficiency in their supplies. In recent years, February 20 has been the target date
26 for the first announcement of all CVP contractors' forecasted water allocations for
27 the upcoming contract year. Forecasts of runoff and operations plans are updated
28 at least monthly between February and May.

29 Reclamation uses the 90 percent probability of exceedance forecast as the basis of
30 water allocations. Furthermore, NMFS reviews the operations plans devised to
31 support the initial water allocation, and any subsequent updates to them, for
32 sufficiency with respect to the criteria for Sacramento River temperature control.

33 **3A.4.2.3 CVP Municipal and Industrial Water Shortage Operational**
34 **Assumptions**

35 Reclamation is in the process of revising the current 2001 draft M&I water
36 shortage policy. A draft EIS was released for public review in 2014. A
37 description of 2001 draft M&I water shortage policy is provided below.

38 **3A.4.2.3.1 Draft 2001 Municipal and Industrial Water Shortage Policy**

39 The CVP has 253 water supply contracts (including water service contracts and
40 Sacramento River Settlement Contracts). These water service contracts have had
41 varying water shortage provisions (e.g., in some contracts, M&I and agricultural

1 users have shared shortages equally; in most of the larger M&I contracts,
2 agricultural water has been shorted 25 percent of its contract water before M&I
3 water was shorted, after which both types of water contractors experience
4 shortages with agricultural users experiencing greater shortages than M&I users,
5 as described below).

6 The M&I minimum shortage allocation described above does not apply to
7 contracts for the (1) Friant Division, (2) New Melones interim supply, (3) Hidden
8 and Buchanan Units, (4) Cross Valley contractors, (5) Wildlife refuges, (6) San
9 Joaquin River Exchange contractors, and (7) Sacramento River Settlement
10 contractors. These contracts have separate shortage-related contractual
11 provisions.

12 There is a minimum shortage allocation for M&I water supplies of 75 percent of a
13 contractor's historical use (i.e., the last 3 years of water deliveries unconstrained
14 by the availability of CVP water). Historical use can be adjusted for growth,
15 extraordinary water conservation measures, and use of non-CVP water as those
16 terms are defined in the proposed policy. Before the M&I water allocation is
17 reduced, the irrigation water allocation would be reduced below 75 percent of
18 contract water.

19 When the allocation of irrigation water is reduced below 25 percent of contract
20 water, Reclamation would reassess the availability of CVP water and CVP water
21 demand; however, due to limited water supplies during these times, M&I water
22 allocation may be reduced below 75 percent of adjusted historical use during
23 extraordinary and rare times such as prolonged and severe drought. Under these
24 extraordinary conditions, allocation percentages for both South of Delta and
25 North of Delta irrigation contractors are reduced below 25 percent to zero while
26 the M&I contractors are reduced below 75 percent to 50 percent by the same
27 increment, as described below.

28 Reclamation would attempt to deliver CVP water to all M&I contractors at not
29 less than a public health and safety level if CVP water is available, if an
30 emergency situation exists, but not exceeding 75 percent of contract total (and
31 taking into consideration water supplies available to the M&I contractors from
32 other sources). This is in recognition, however, that the M&I allocation may,
33 nevertheless, fall to 50 percent as the irrigation allocation drops below 25 percent
34 and approaches zero due to limited CVP supplies.

35 • Allocation Assumptions for Below Normal, Above Normal, and Wet Years:

36	– Agricultural 100 percent to 75 percent	M&I is at 100 percent
37	– Agricultural 70 percent	M&I 95 percent
38	– Agricultural 65 percent	M&I 90 percent
39	– Agricultural 60 percent	M&I 85 percent
40	– Agricultural 55 percent	M&I 80 percent
41	– Agricultural 50 to 25 percent	M&I 75 percent

- 1 • Allocation Assumptions for Dry and Critical Years:
 - 2 – Agricultural 20 percent M&I 70 percent
 - 3 – Agricultural 15 percent M&I 65 percent
 - 4 – Agricultural 10 percent M&I 60 percent
 - 5 – Agricultural 5 percent M&I 55 percent
 - 6 – Agricultural 0 percent M&I 50 percent

7 **3A.4.3 Project Facilities**

8 **3A.4.3.1 Trinity River Division Operations**

9 The Trinity River Division, completed in 1964, includes facilities to store and
10 regulate water in the Trinity River, as well as facilities to divert water to the
11 Sacramento River Basin. The Trinity River Division includes the Trinity River
12 and Dam, Lewiston Dam, Whiskeytown Reservoir and Dam, Clear Creek, and
13 Spring Creek and Debris Dam. Trinity Dam is located on the Trinity River and
14 regulates the flow from a drainage area of approximately 720 square miles. The
15 dam was completed in 1962, forming Trinity Lake, which has a maximum storage
16 capacity of approximately 2.4 MAF.

17 Water is diverted from the Trinity River at Lewiston Dam via the Clear Creek
18 Tunnel and passes through the Judge Francis Carr Powerhouse as it is discharged
19 into Whiskeytown Lake on Clear Creek. From Whiskeytown Lake, water is
20 released through the Spring Creek Power Conduit to the Spring Creek Power
21 Plant and into Keswick Reservoir. All of the water diverted from the Trinity
22 River, plus a portion of Clear Creek flows, is diverted through the Spring Creek
23 Power Conduit into Keswick Reservoir.

24 Spring Creek also flows into the Sacramento River and enters at Keswick
25 Reservoir. Flows on Spring Creek are partially regulated by the Spring Creek
26 Debris Dam. Historically (1964–1992), an average annual quantity of 1,269 TAF
27 of water has been diverted from Whiskeytown Lake to Keswick Reservoir. This
28 annual quantity is approximately 17 percent of the flow measured in the
29 Sacramento River at Keswick.

30 The mean annual inflow to Trinity Lake from the Trinity River is about 1.2 MAF
31 per year. Historically, an average of about two-thirds of the annual inflow has
32 been diverted to the Sacramento River Basin (1991–2003).

33 **3A.4.3.1.1 Safety of Dams at Trinity Reservoir**

34 Periodically, increased water releases are made from Trinity Dam consistent with
35 Reclamation Safety of Dams criteria intended to prevent overtopping of Trinity
36 Dam. Although flood control is not an authorized purpose of the Trinity River
37 Division, flood control benefits are provided through normal operations.

38 The Safety of Dams release criteria specify that Carr power plant capacity be used
39 as a first preference destination for Safety of Dams releases made at Trinity Dam.
40 Trinity River releases are made as a second preference destination. During
41 significant Northern California high-water flood events, the Sacramento River

1 water stages are also often at concern levels. Under such high-water conditions,
2 the water that would otherwise move through the Carr power plant is routed to the
3 Trinity River. Total river releases are capped at 11,000 cfs from Lewiston Dam
4 (under Safety of Dams criteria) due to local high water concerns in the floodplain
5 and local bridge flow capacities. The Safety of Dams criteria provide seasonal
6 storage targets and recommended releases November 1 to March 31. During the
7 May 2006 event, the river flows were over 10,000 cfs for several days as part of
8 the fishery restoration flows.

9 **3A.4.3.1.2 Fish and Wildlife Requirements on Trinity River**

10 Based on the Trinity River Main-stem Fishery Restoration ROD, dated
11 December 19, 2000, 368.6 TAF to 815 TAF is allocated annually for Trinity
12 River flows, depending on water year type. This amount is scheduled in
13 coordination with USFWS to best meet habitat, temperature, and sediment
14 transport objectives in the Trinity Basin.

15 Temperature objectives for the Trinity River are set forth in SWRCB Water
16 Rights Order 90-5, as summarized in Table 3A.2. These objectives vary by reach
17 and by season. Between Lewiston Dam and Douglas City Bridge, the daily
18 average temperature should not exceed 60 degrees Fahrenheit (°F) from July 1 to
19 September 14, and 56°F from September 15 to September 30. From October 1 to
20 December 31, the daily average temperature should not exceed 56°F between
21 Lewiston Dam and the confluence of the North Fork Trinity River. Reclamation
22 consults with USFWS in establishing a schedule of releases from Lewiston Dam
23 that can best achieve these objectives.

24 For the purpose of determining the Trinity Basin water year type, forecasts using
25 the 50 percent exceedance as of April 1 are used. There are no make-up or
26 increases for flows forgone if the water year type changes up or down from an
27 earlier 50 percent forecast. In the modeling, actual historic Trinity inflows were
28 used rather than a forecast. There is a temperature curtain in Lewiston Reservoir
29 that provides for temperature management for the diversions to Clear Creek
30 Tunnel.

31 **Table 3A.2 Water Temperature Objectives for the Trinity River during the Summer,**
32 **Fall, and Winter as Established by the California Regional Water Quality Control**
33 **Board North Coast Region**

Date	Temperature Objective (°F)	
	Douglas City (RM 93.8)	North Fork Trinity River (RM 72.4)
July 1 through September 14	60	–
September 15 through September 30	56	–
October 1 through December 31	–	56

1 **3A.4.3.1.3 Transbasin Diversions**

2 Diversion of Trinity water to the Sacramento Basin provides water supply and
3 major hydroelectric power generation for the CVP and plays a key role in water
4 temperature control in the Trinity River and upper Sacramento River. The
5 amounts of the Trinity exports are determined by subtracting Trinity River
6 scheduled flow and targeted carryover storage from the forecasted Trinity water
7 supply.

8 The seasonal timing of Trinity exports is a result of determining how to make best
9 use of a limited volume of Trinity export (in concert with releases from Shasta
10 Lake) to help conserve cold water pools and meet temperature objectives on the
11 upper Sacramento and Trinity Rivers, as well as power production economics. A
12 key consideration in the export timing determination is the thermal degradation
13 that occurs in Whiskeytown Lake due to the long residence time of transbasin
14 exports in the lake.

15 To minimize the thermal degradation effects, transbasin export patterns are
16 typically scheduled by an operator to provide an approximate 120 TAF volume to
17 occur in late spring to create a thermal connection to the Spring Creek
18 Powerhouse before larger transbasin volumes are scheduled to occur during the
19 hot summer months. Typically, the water flowing from the Trinity Basin through
20 Whiskeytown Lake must be sustained at fairly high rates to avoid warming and to
21 function most efficiently for temperature control. The time period for which
22 effective temperature control releases can be made from Whiskeytown Lake may
23 be compressed when the total volume of Trinity water available for export is
24 limited.

25 Export volumes from Trinity are made in coordination with the operation of
26 Shasta Lake. Other important considerations affecting the timing of Trinity
27 exports are based on the utility of power generation and allowances for normal
28 maintenance of the diversion works and generation facilities.

29 Trinity Lake historically reached its greatest storage level at the end of May.
30 With the present pattern of prescribed Trinity releases, maximum storage may
31 occur by the end of April or in early May.

32 Reclamation maintains at least 600 TAF in Trinity Reservoir, except during the
33 10 to 15 percent of the years when Shasta Lake is also drawn down. Reclamation
34 addresses end-of-water-year carryover on a case-by-case basis in dry and
35 critically dry water year types with USFWS and NMFS through the WOMT and
36 (b)(2)IT processes.

37 **3A.4.3.1.4 Whiskeytown Reservoir Operations**

38 Whiskeytown Reservoir is normally operated to (1) regulate inflows for power
39 generation and recreation; (2) support upper Sacramento River temperature
40 objectives; and (3) provide for releases to Clear Creek consistent with the CVPIA
41 Anadromous Fish Restoration Program (AFRP) objectives. Although it stores up
42 to 241 TAF, this storage is not normally used as a source of water supply. Two

1 temperature curtains in Whiskeytown Reservoir were installed in 1993 to pass
2 cold water through the reservoir and to help regulate the temperature range
3 requirements of salmon eggs and sac-fry. The curtains were made of reinforced
4 rubber sheets that form a continuous barrier under the water. The Oak Bottom
5 Temperature Control Curtain or OBTCC is located in the upstream portion of the
6 reservoir and causes inflowing cold water to sink to the bottom. The OBTCC was
7 originally 600 feet long and reached a depth of 40 feet. However, the OBTCC
8 was damaged and cannot be fully deployed. The curtain is estimated to be
9 repaired by 2030 under the No Action Alternative, depending on available
10 funding and subject to environmental compliance requirements. The Spring
11 Creek curtain is located near Whiskeytown Dam to maximize cold water flows
12 through the intakes into the Spring Creek Power Conduit. It was damaged
13 significantly, and was replaced in 2011.

14 *Implementation of 2009 National Marine Fisheries Service Biological*
15 *Opinion*

16 In accordance with the 2009 NMFS BO RPA Action I.1.5, Reclamation is
17 required to manage Whiskeytown Lake releases to meet daily water temperatures
18 in Clear Creek at Igo of:

- 19 • 60° F from June 1 through September 15
20 • 56° F from September 15 through October 31

21 **3A.4.3.1.5 Historic Spillway Flows below Whiskeytown Lake**

22 Whiskeytown Lake is annually drawn down by approximately 35 TAF of storage
23 space during November through April to regulate flows for power generation.
24 Heavy rainfall events occasionally result in spillway discharges to Clear Creek, as
25 shown in Table 3A.3 below.

26 **Table 3A.3 Days of Spilling below Whiskeytown and 40-30-30 Index from Water**
27 **Year 1978 to 2012**

Water Year	Days of Spilling	40-30-30 Index
1978	5	AN
1979	0	BN
1980	0	AN
1981	0	D
1982	63	W
1983	81	W
1984	0	W
1985	0	D
1986	17	W
1987	0	D
1988	0	C
1989	0	D
1990	8	C

Water Year	Days of Spilling	40-30-30 Index
1991	0	C
1992	0	C
1993	10	AN
1994	0	C
1995	14	W
1996	0	W
1997	5	W
1998	8	W
1999	0	W
2000	0	AN
2001	0	D
2002	0	D
2003	8	AN
2004	0	BN
2005	0	AN
2006	4	W
2007	0	D
2008	0	C
2009	0	D
2010	6	BN
2011	0	W
2012	0	BN

1 Notes: W = Wet Year Water Year Type; AN = Above Normal Water Year Type; BN =
2 Below Normal Water Year Type; D = Dry Water Year Type; and C = Critical Dry Water
3 Year Type.

4 Operations at Whiskeytown Lake during flood conditions are complicated by its
5 operational relationship with the Trinity River, Sacramento River, and Clear
6 Creek. On occasion, imports of Trinity River water to Whiskeytown Reservoir
7 may be suspended to avoid aggravating high flow conditions in the Sacramento
8 Basin. Joint temperature control objectives also similarly interact among the
9 Trinity River, Clear Creek, and Sacramento River.

10 **3A.4.3.1.6 Fish and Wildlife Requirements on Clear Creek**

11 CVPIA (b)(2) operations and water rights permits issued by the SWRCB for
12 diversions from Trinity River and Clear Creek specify minimum downstream
13 releases from Lewiston and Whiskeytown Dams, respectively. The following
14 agreements govern releases from Whiskeytown Lake.

- 15 • A 1960 Memorandum of Agreement (MOA) with CDFW established
16 minimum flows to be released to Clear Creek at Whiskeytown Dam, as
17 summarized in Table 3A.4.

- 1 • A 1963 release schedule for Whiskeytown Dam was developed with USFWS
2 and implemented, but never finalized. Although this release schedule was
3 never formalized, Reclamation has used this flow schedule for minimum
4 flows since May 1963.
- 5 • Water rights permit modification in 2002 that allowed release of water from
6 Whiskeytown Lake into Clear Creek for the purposes of maintenance of fish
7 and wildlife resources as provided for in Provision 2.1 of Instream Flow
8 Preservation Agreement by and among Reclamation, USFWS, and DFW,
9 dated August 11, 2000.
- 10 • Dedication of (b)(2) water on Clear Creek provides instream flows below
11 Whiskeytown Dam greater than the minimum flows (that would have
12 occurred under pre-CVPIA conditions). Instream flow objectives are usually
13 taken from the AFRP plan, in consideration of spawning and incubation of
14 fall-run Chinook Salmon. Augmentation in the summer months is usually in
15 consideration of water temperature objectives for steelhead and in late
16 summer for spring-run Chinook Salmon.

17 **Table 3A.4 Minimum Flows at Whiskeytown Dam**

Period	Minimum flow (cfs)
1960 MOA with CDFW	
January 1–February 28(29)	50
March 1–May 31	30
June 1–September 30	0
October 1–October 15	10
October 16–October 31	30
November 1–December 31	100
1963 USFWS Proposed Normal year flow	
January 1–October 31	50
November 1–December 31	100
1963 USFWS Proposed Critical year flow	
January 1–October 31	30
November 1–December 31	70
2002 Water Right Modification for Critical year flow	
January 1–October 31	50
November 1–December 31	70

18 The 2009 NMFS BO RPA requires Reclamation to release spring attraction flows
19 for adult spring-run Chinook Salmon (Action I.1.1) and channel maintenance
20 flows in Clear Creek (Action I.1.2); and to continue gravel augmentation
21 programs initiated under CVPIA. The spring attraction flows are to be released
22 from Whiskeytown Lake into Clear Creek in at least two pulse flows of at least
23 600 cfs, each lasting at least 3 days, in May and June.

1 Under the 2009 NMFS BO RPA, the channel maintenance flows are to be
2 released at a minimum flow of 3,250 cfs for 24 hours, which exceeds the
3 1,240 cfs capacity of the Whiskeytown Dam outlet to Clear Creek. This action is
4 to occur seven times in a ten year period. Therefore, to provide channel
5 maintenance flows, the Whiskeytown Lake water elevation must be increased to
6 provide flow of water over the Glory Hole inlet. The Glory Hole is designed to
7 operate with the higher water elevations expected during flood events. However,
8 during non-flood periods, raising the water elevations and operating the Glory
9 Hole inlet can cause safety concerns for recreationists along the Whiskeytown
10 Lake shoreline.

11 **3A.4.3.1.7 Spring Creek Debris Dam Operations**

12 The Spring Creek Debris Dam (SCDD) is a feature of the Trinity Division of the
13 CVP. It was constructed to regulate runoff containing debris and acid mine
14 drainage from Spring Creek, a tributary to the Sacramento River that enters
15 Keswick Reservoir. The SCDD can store approximately 5.8 TAF of water.
16 Operation of SCDD and Shasta Dam has allowed some control of the toxic wastes
17 with dilution criteria. In January 1980, Reclamation, CDFW, and SWRCB
18 executed a Memorandum of Understanding (MOU) to implement actions that
19 protect the Sacramento River system from heavy metal pollution from Spring
20 Creek and adjacent watersheds. The MOU identifies agency actions and
21 responsibilities, and establishes release criteria based on allowable concentrations
22 of total copper and zinc in the Sacramento River below Keswick Dam.

23 The MOU states that Reclamation agrees to operate to dilute releases from SCDD
24 (according to the criteria and schedules provided), that such operation would not
25 cause flood control parameters on the Sacramento River to be exceeded, and
26 would not unreasonably interfere with other Project requirements as determined
27 by Reclamation. The MOU also specifies a minimum schedule for monitoring
28 copper and zinc concentrations at SCDD and in the Sacramento River below
29 Keswick Dam. Reclamation has primary responsibility for the monitoring;
30 however, CDFW and RWQCB also collect and analyze samples on an as-needed
31 basis. Due to more extensive monitoring, improved sampling and analysis
32 techniques, and continuing cleanup efforts in the Spring Creek drainage basin,
33 Reclamation now operates SCDD to target the more stringent Central Valley
34 Region Water Quality Control Board Plan (CVRWQCB Basin Plan) criteria in
35 addition to the MOU goals. Instead of the total copper and total zinc criteria
36 contained in the MOU, Reclamation operates SCDD releases and Keswick
37 dilution flows to not exceed the CVRWQCB Basin Plan standards of
38 0.0056 milligrams per liter (mg/L) dissolved copper and 0.016 mg/L dissolved
39 zinc. Release rates are estimated from a mass balance calculation of the copper
40 and zinc in the debris dam release and in the river.

41 In order to minimize the build-up of metal concentrations in the Spring Creek arm
42 of Keswick Reservoir, releases from the debris dam are coordinated with releases
43 from the Spring Creek Power Plant to keep the Spring Creek arm of Keswick
44 Reservoir in circulation with the main water body of Keswick Lake.

1 The operation of SCDD is complicated during major heavy rainfall events.
2 SCDD reservoir can fill to uncontrolled spill elevations in a relatively short time
3 period, anywhere from days to weeks. Uncontrolled spills at SCDD can occur
4 during major flood events on the upper Sacramento River and also during
5 localized rainfall events in the Spring Creek watershed. During flood control
6 events, Keswick releases may be reduced to meet flood control objectives at Bend
7 Bridge when storage and inflow at Spring Creek Reservoir are high.

8 Because SCDD releases are maintained as a dilution ratio of Keswick releases to
9 maintain the required dilution of copper and zinc, uncontrolled spills can and have
10 occurred from SCDD. In this operational situation, high metal concentration
11 loads during heavy rainfall are usually limited to areas immediately downstream
12 of Keswick Dam because of the high runoff entering the Sacramento River,
13 adding dilution flow. In the operational situation when Keswick releases are
14 increased for flood control purposes, SCDD releases are also increased in an
15 effort to reduce spill potential.

16 In the operational situation when heavy rainfall events would fill SCDD and
17 Shasta Lake would not reach flood control conditions, increased releases from
18 CVP storage may be required to maintain desired dilution ratios for metal
19 concentrations. Reclamation has voluntarily released additional water from CVP
20 storage to maintain release ratios for toxic metals below Keswick Dam.
21 Reclamation has typically attempted to meet the CVRWQCB Basin Plan
22 standards but these releases have no established criteria and are dealt with on a
23 case-by-case basis. Since water released for dilution of toxic spills is likely to be
24 in excess of other CVP requirements, such releases increase the risk of a loss of
25 water for other beneficial purposes.

26 **3A.4.3.2 Shasta Division and Sacramento River Division**

27 The CVP's Shasta Division includes facilities that conserve water in the
28 Sacramento River for:

- 29 • Flood control
- 30 • Navigation maintenance
- 31 • Agricultural water supplies
- 32 • M&I water supplies
- 33 • Hydroelectric power generation
- 34 • Conservation of fish in the Sacramento River
- 35 • Protection of the Delta from intrusion of saline ocean water.

36 The Shasta Division includes Shasta Dam, Lake, and Power Plant; Keswick Dam,
37 Reservoir, and Power Plant, and the Shasta Temperature Control Device.

38 The Sacramento River Division was authorized after completion of the Shasta
39 Division. The Sacramento River Division includes facilities for the diversion and
40 conveyance of water to CVP contractors on the west side of the Sacramento
41 River. The division includes the Sacramento Canals Unit, which was authorized
42 in 1950 and consists of the Red Bluff Pumping Plant, the Corning Pumping Plant,

1 and the Corning and Tehama-Colusa Canals. Total authorized diversions for the
2 Sacramento River Division are approximately 2.8 MAF. Historically the total
3 diversion has varied from 1.8 MAF in a critically dry year to the full 2.8 MAF in
4 a wet year, including diversions by Sacramento River Settlement contractors and
5 CVP water service contractors. Sacramento River Settlement contractors divert
6 water under their own water rights and through their own facilities.

7 The Sacramento Canals Unit was authorized to supply irrigation water to over
8 200,000 acres of land in the Sacramento Valley, principally in Tehama, Glenn,
9 Colusa, and Yolo counties. Black Butte Dam, which is operated by the
10 U.S. Army Corps of Engineers (USACE), also provides supplemental water to the
11 Tehama-Colusa Canals as it crosses Stony Creek. The operations of the Shasta
12 and Sacramento River divisions are presented together because of their
13 operational inter-relationships.

14 Shasta Dam is located on the Sacramento River just below the confluence of the
15 Sacramento, McCloud, and Pit Rivers. The dam regulates the flow from a
16 drainage area of approximately 6,649 square miles. Shasta Dam was completed
17 in 1945, forming Shasta Lake, which has a maximum storage capacity of
18 4.552 MAF. Water in Shasta Lake is released through or around the Shasta
19 Power Plant to the Sacramento River, where it is re-regulated downstream by
20 Keswick Dam. A small amount of water is diverted directly from Shasta Lake for
21 M&I uses by local communities.

22 Keswick Reservoir was formed by the completion of Keswick Dam in 1950. It
23 has a capacity of approximately 23.8 TAF and serves as an afterbay for releases
24 from Shasta Dam and for discharges from the Spring Creek Power Plant. All
25 releases from Keswick Reservoir are made to the Sacramento River from
26 Keswick Dam. The dam has a fish trapping facility that operates in conjunction
27 with the Coleman National Fish Hatchery on Battle Creek.

28 **3A.4.3.2.1 Flood Control**

29 Flood control objectives for Shasta Lake require that releases be restricted to
30 quantities that would not cause downstream flows or stages to exceed specified
31 levels. These include a flow of 79,000 cfs at the tailwater of Keswick Dam, and a
32 stage of 39.2 feet in the Sacramento River at Bend Bridge gauging station, which
33 corresponds to a flow of approximately 100,000 cfs. Flood control operations are
34 based on regulating criteria developed by the USACE pursuant to the provisions
35 of the Flood Control Act of 1944. Maximum flood space reservation is 1.3 MAF,
36 with variable storage space requirements based on an inflow parameter.

37 Flood control operation at Shasta Lake requires forecasting runoff conditions into
38 Shasta Lake and runoff conditions of unregulated creek systems downstream from
39 Keswick Dam as far in advance as possible. A critical element of upper
40 Sacramento River flood operations is the local runoff entering the Sacramento
41 River between Keswick Dam and Bend Bridge.

1 The unregulated creeks (major creek systems are Cottonwood Creek, Cow Creek,
2 and Battle Creek) in this reach of the Sacramento River can be very sensitive to a
3 large rainfall event and produce high rates of runoff into the Sacramento River in
4 short time periods. During large rainfall and flooding events, the local runoff
5 between Keswick Dam and Bend Bridge can exceed 100,000 cfs.

6 The travel time required for release changes at Keswick Dam to affect Bend
7 Bridge flows is approximately 8 to 10 hours. If the total flow at Bend Bridge is
8 projected to exceed 100,000 cfs, the release from Keswick Dam is decreased to
9 maintain Bend Bridge flow below 100,000 cfs. As the flow at Bend Bridge is
10 projected to recede, the Keswick Dam release is increased to evacuate water
11 stored in the flood control space at Shasta Lake. Changes to Keswick Dam
12 releases are scheduled to minimize rapid fluctuations in the flow at Bend Bridge.

13 The flood control criteria for Keswick releases specify that releases should not be
14 increased more than 15,000 cfs or decreased more than 4,000 cfs in any 2-hour
15 period. The restriction on the rate of decrease is intended to prevent sloughing of
16 saturated downstream channel embankments caused by rapid reductions in river
17 stage. In rare instances, the rate of decrease may have to be accelerated to avoid
18 exceeding critical flood stages downstream.

19 **3A.4.3.2.2 Fish and Wildlife Requirements in the Sacramento River**

20 Reclamation operates the Shasta, Sacramento River, and Trinity River divisions
21 of the CVP to meet (to the extent possible) the provisions of SWRCB
22 Order 90-05. An April 5, 1960, MOA between Reclamation and CDFW
23 originally established flow objectives in the Sacramento River for the protection
24 and preservation of fish and wildlife resources. The agreement provided for
25 minimum releases into the natural channel of the Sacramento River at Keswick
26 Dam for normal and critically dry years (Table 3A.5). Since October 1981,
27 Keswick Dam has operated based on a minimum release of 3,250 cfs for normal
28 years from September 1 through the end of February, in accordance with an
29 agreement between Reclamation and CDFW. This release schedule was included
30 in SWRCB Order 90-05, which maintains a minimum release of 3,250 cfs at
31 Keswick Dam and Red Bluff Pumping Plant from September through the end of
32 February in all water years except critically dry years.

1 **Table 3A.5 Minimum Flow Requirements and Objectives (cfs) on the Sacramento**
2 **River below Keswick Dam**

Period	MOA	Water Rights 90-5	MOA and Water Rights 90-5
Water Year Type	Normal	Normal	Critically Dry
January 1–February 28(29)	2,600	3,250	2,000
March 1–March 31	2,300	2,300	2,300
April 1–April 30	2,300	2,300	2,300
May 1–August 31	2,300	2,300	2,300
September 1–September 30	3,900	3,250	2,800
October 1–November 30	3,900	3,250	2,800
December 1–December 31	2,600	3,250	2,000

3 The 1960 MOA between Reclamation and CDFW provides that releases from
4 Keswick Dam (from September 1 through December 31) are made with minimum
5 water level fluctuation or change to protect salmon to the extent compatible with
6 other operations requirements.

7 Reclamation usually attempts to reduce releases from Keswick Dam to the
8 minimum fishery requirement by October 15 each year and to minimize changes
9 in Keswick releases between October 15 and December 31. Releases may be
10 increased during this period to meet downstream needs such as higher outflows in
11 the Delta to meet water quality requirements, or to meet flood control
12 requirements. Releases from Keswick Dam may be reduced when downstream
13 tributary inflows increase to a level that would meet flow needs. Reclamation
14 attempts to establish a base flow that minimizes release fluctuations to reduce
15 impacts to fisheries and bank erosion from October through December.

16 The Connelly-Areias-Chandler Rice Straw Burning Reduction Act of 1991
17 changed agricultural water diversion practices along the Sacramento River and
18 has affected Keswick Dam release rates in the fall. This program is generally
19 known as the Rice Straw Decomposition and Waterfowl Habitat Program. Prior
20 to this change, the preferred method of clearing fields of rice stubble was to
21 systematically burn it. Today, rice field burning has been phased out due to air
22 quality concerns and has been replaced in some areas by a program of rice field
23 flooding that decomposes rice stubble and provides additional waterfowl habitat.
24 The result has been an increase in water demand to flood rice fields in October
25 and November, which has increased the need for higher Keswick releases in all
26 but the wettest of fall months.

27 **3A.4.3.2.3 Minimum Flow for Navigation as Measured at Wilkins Slough**

28 Historical commerce on the Sacramento River resulted in a CVP authorization to
29 maintain minimum flows of 5,000 cfs at Chico Landing to support navigation in

1 accordance with references to Sacramento River Division operations in the River
2 and Harbors Act of 1935 and the Rivers and Harbors Act of 1937. Currently,
3 there is no commercial traffic between Sacramento and Chico Landing, and
4 USACE has not dredged this reach to preserve channel depths since 1972.
5 However, long-time water users diverting from the river have set their pump
6 intakes just below this level and cannot easily divert when lower river elevations
7 occur with lower flows. Therefore, the CVP is operated to meet the navigation
8 flow requirement of 5,000 cfs to Wilkins Slough, (gauging station on the
9 Sacramento River), under all but the most critical water supply conditions, to
10 facilitate pumping and use of screened diversions.

11 At flows below 5,000 cfs at Wilkins Slough, diverters have reported increased
12 pump cavitation as well as greater pumping head requirements. Diverters are able
13 to operate for extended periods at flows as low as 4,000 cfs at Wilkins Slough, but
14 pumping operations become severely affected and some pumps become
15 inoperable at flows lower than this. Flows may drop as low as 3,500 cfs for short
16 periods while changes are made in Keswick releases to reach target levels at
17 Wilkins Slough, but using the 3,500 cfs rate as a target level for an extended
18 period would have major impacts on diverters.

19 *Implementation of 2009 National Marine Fisheries Service Biological Opinion*
20 The 2009 NMFS BO Action I.4 required Reclamation to evaluate approaches to
21 provide minimum flows at Wilkins Slough of less than 5,000 cfs.

22 **3A.4.3.2.4 Water Temperature Operations in the Upper Sacramento River**

23 Water temperature on the Sacramento River system is influenced by several
24 factors, including the relative water temperatures and ratios of releases from
25 Shasta Dam and from the Spring Creek Power Plant. The temperature of water
26 released from Shasta Dam and the Spring Creek Power Plant is a function of the
27 reservoir temperature profiles at the discharge points at Shasta and Whiskeytown,
28 the depths from which releases are made, the seasonal management of the deep
29 cold water reserves, ambient seasonal air temperatures and other climatic
30 conditions, tributary accretions and water temperatures, and residence time in
31 Keswick, Whiskeytown and Lewiston Reservoirs, and in the Sacramento River.
32 Water temperature in the upper Sacramento River is governed by current water
33 rights permit requirements.

34 In 1990 and 1991, SWRCB issued Water Rights Orders 90-05 and 91-01
35 modifying Reclamation's water rights for the Sacramento River. The orders
36 stated that Reclamation shall operate Keswick and Shasta Dams and the Spring
37 Creek Power Plant to meet a daily average water temperature of 56°F as far
38 downstream in the Sacramento River as practicable during periods when higher
39 temperature would be harmful to fisheries. The optimal control point is the Red
40 Bluff Pumping Plant.

41 Under the orders, the water temperature compliance point may be modified when
42 the objective cannot be met at Red Bluff Pumping Plant. In addition, SWRCB
43 Order 90-05 modified the minimum flow requirements initially established in the

1 1960 MOA for the Sacramento River below Keswick Dam. The water right
2 orders also recommended the construction of a Shasta Temperature Control
3 Device (TCD) to improve the management of the limited cold water resources.

4 Pursuant to SWRCB Orders 90-05 and 91-01, Reclamation configured and
5 implemented the Sacramento-Trinity Water Quality Monitoring Network to
6 monitor temperature and other parameters at key locations in the Sacramento and
7 Trinity Rivers. SWRCB orders also required Reclamation to establish the
8 SRTTG to formulate, monitor, and coordinate temperature control plans for the
9 upper Sacramento and Trinity Rivers. This group consists of representatives from
10 Reclamation, SWRCB, NMFS, USFWS, CDFW, Western, DWR, and the Hoopa
11 Valley Indian Tribe.

12 Each year, with finite cold water resources and competing demands usually an
13 issue, the SRTTG devise operation plans with the flexibility to provide the best
14 protection consistent with the CVP's temperature control capabilities and
15 considering the annual needs and seasonal spawning distribution monitoring
16 information for winter-run and fall-run Chinook Salmon. In every year since
17 SWRCB issued the orders, those plans have included modifying the Red Bluff
18 Pumping Plant compliance point to make best use of the cold water resources
19 based on the location of spawning Chinook Salmon. These modifications
20 occurred in 2012. Reports are submitted periodically to SWRCB over the
21 temperature control season defining our temperature operation plans. SWRCB
22 has overall authority to determine if the plan is sufficient to meet water right
23 permit requirements.

24 *Implementation of 2009 National Marine Fisheries Service Biological Opinion*

25 The 2009 NMFS BO RPA Action I.2.1 requires Reclamation to achieve the
26 following carryover storage performance measures for Shasta Lake to maintain
27 the cold water volume needed to meet downstream temperature requirements.

- 28 • 87 percent of the years: 2,200 TAF end-of-September storage
- 29 • 82 percent of the years: .2,200 TAF end-of-September storage and 3,800 TAF
30 end-of-April storage in following year
- 31 • 40 percent of the years: 3,200 TAF end-of-September storage

32 The 2009 NMFS BO RPA requires Reclamation to achieve the following
33 temperature requirements over a ten year running average.

- 34 • 95 percent of the years: Clear Creek temperature compliance
- 35 • 85 percent of the years: Ball's Ferry temperature compliance
- 36 • 40 percent of the years: Jelly's Ferry temperature compliance
- 37 • 15 percent of the years: Bend Bridge temperature compliance

38 From November through February, if the end-of-September storage in Shasta
39 Lake is equal to or greater than 2,400 TAF by October 15, Reclamation is
40 required to work with NMFS, and CDFW to develop a release schedule that
41 would consider the need to maintain flood control space in Shasta Lake (which

1 results in a maximum storage of 3,250 TAF at the end-of-November), and a the
2 need to provide stable Sacramento River flows and elevations during this period.
3 If the end-of-September storage in Shasta Lake is between 1,900 and 2,400 TAF,
4 a monthly release schedule for this period must be developed to consider
5 maintaining Keswick Reservoir releases between 3,250 and 7,000 cfs; flows to
6 support fall-run Chinook Salmon in accordance with the CVPIA AFRP
7 guidelines; and provide for conservative Keswick Reservoir releases in drier
8 years. If end-of-September storage in Shasta Lake is less than 1,900 TAF,
9 Keswick Reservoir releases are reduced to 3,250 cfs in early October unless the
10 flows are needed for temperature compliance, and if needed, reduce discretionary
11 deliveries; and develop projected monthly deliveries for the period to maintain
12 releases of 3,250 cfs, and if needed, reduce CVP and SWP Delta exports to meet
13 Delta outflow and other legal requirements.

14 From April 15 through May 15, water temperatures are to be maintained at 56° F
15 between Ball's Ferry and Bend Bridge. In addition, in March, Reclamation uses
16 projections of CVP water availability, based upon a 90 percent forecast, to project
17 the ability to meet temperature compliance at Ball's Ferry and achieve an end-of-
18 September storage in Shasta Lake of 2,200 TAF. If the projections indicate that
19 only one of the objectives can be met, releases from Keswick Reservoir would be
20 reduced to 3,250 cfs unless another release pattern is agreed upon with NMFS.
21 The release pattern would consider actions to maintain monthly average flows for
22 Reclamation's non-discretionary delivery obligations; provide flows for the
23 biological needs of spring life stages of species addressed in the 2009 NMFS BO;
24 and approaches, including reductions in Delta exports, to meet Delta outflow and
25 other legal requirements while not reducing Keswick Reservoir releases. If the
26 projections indicate that the Clear Creek temperature compliance point or the
27 1,900 TAF end-of-September Shasta Lake storage cannot be met, Reclamation
28 would develop a plan to manage the cold water pool in Whiskeytown Reservoir
29 and Shasta Lake through several operational changes, including a reduction in the
30 Wilkins Slough flow criteria (discussed above) to 4,000 cfs.

31 For operations from May 15 through October, Reclamation would develop a
32 Temperature Management Plan to achieve temperatures of 56° F or less at
33 compliance locations between Ball's Ferry and Bend Bridge.

34 **3A.4.3.2.5 Shasta Temperature Control Device**

35 Construction of the TCD at Shasta Dam was completed in 1997. This device is
36 designed for greater flexibility in managing the cold water reserves in Shasta Lake
37 while enabling hydroelectric power generation to occur and to improve salmon
38 habitat conditions in the upper Sacramento River. The TCD is also designed to
39 enable selective release of water from varying lake levels through the power plant
40 in order to manage and maintain adequate water temperatures in the Sacramento
41 River downstream of Keswick Dam.

42 Prior to construction of the Shasta TCD, Reclamation released water from Shasta
43 Dam's low-level river outlets to alleviate high water temperatures during critical

1 periods of the spawning and incubation life stages of the winter-run Chinook
2 Salmon stock. The release of water through the low-level river outlets was a
3 major facet of Reclamation’s efforts to control upper Sacramento River
4 temperatures from 1987 through 1996. Releases through the low-level outlets
5 bypass the power plant and result in a loss of hydroelectric generation at the
6 Shasta Power Plant.

7 The seasonal operation of the TCD is generally as follows: during mid-winter and
8 early spring the highest possible elevation gates are utilized to draw from the
9 upper portions of the lake to conserve deeper colder resources (Table 3A.6).
10 During late spring and summer, the operators begin the seasonal progression of
11 opening deeper gates as Shasta Lake elevation decreases and cold water resources
12 are utilized. In late summer and fall, the TCD side gates are opened to utilize the
13 remaining cold water resource below the Shasta Power Plant elevation in
14 Shasta Lake.

15 **Table 3A.6 Shasta Temperature Control Device Gates with Elevation and Storage**

TCD Gates	Shasta Elevation with 35 feet of Submergence (feet)	Shasta Storage (MAF)
Upper Gates	1,035	~3.65
Middle Gates	935	~2.50
Pressure Relief Gates	840	~0.67
Side Gates	720*	~0.01

16 Note:
17 *Low level intake bottom

18 The seasonal progression of the Shasta TCD operation is designed to maximize
19 the conservation of cold water resources deep in Shasta Lake, until the time the
20 resource is of greatest management value for fishery management purposes.
21 Recent operational experience with the Shasta TCD has demonstrated significant
22 operational flexibility improvement for cold water conservation and upper
23 Sacramento River water temperature and fishery habitat management purposes.
24 Recent operational experience has also demonstrated the Shasta TCD has
25 significant leaks that are inherent to TCD design. Also, operational uncertainties
26 cumulatively impair the seasonal performance of the Shasta TCD to a greater
27 degree than was anticipated in previous analysis and modeling used to describe
28 long-term Shasta TCD benefits.

29 **3A.4.3.2.6 CVPIA 3406 (b)(2) Operations on the Upper Sacramento River**

30 Dedication of (b)(2) water on the Sacramento River provides instream flows
31 below Keswick Dam greater than those that would have occurred under
32 pre-CVPIA conditions, e.g., the fish and wildlife requirements specified in
33 SWRCB Order 90-5 and the temperature criteria formalized in the 1993 NMFS
34 winter-run Chinook Salmon BO as the base. Instream flow objectives from
35 October 1 to April 15 (typically April 15 is when water temperature objectives for
36 winter-run Chinook Salmon become the determining factor) are usually selected

1 to minimize dewatering of redds and provide suitable habitat for salmonid
2 spawning, incubation, rearing, and migration.

3 **3A.4.3.2.7 Anderson-Cottonwood Irrigation District Diversion Dam**

4 Anderson Cottonwood Irrigation District (ACID) holds senior water rights and
5 has diverted into the ACID Canal for irrigation along the west side of the
6 Sacramento River between Redding and Cottonwood since 1916. The United
7 States and ACID signed a contract providing for Project water service and
8 agreement on diversion of water. ACID diverts to its main canal (on the right
9 bank of the river) from a diversion dam located in Redding about 5 miles
10 downstream from Keswick Dam.

11 Close coordination between Reclamation and ACID is required for regulation of
12 river flows to ensure safe operation of ACID's diversion dam during the irrigation
13 season. The irrigation season for ACID runs from April through October.

14 Keswick release rate decreases required for the ACID operations are limited to
15 15 percent in a 24-hour period and 2.5 percent in any one hour. Therefore,
16 advance notification is important when scheduling decreases to allow for the
17 installation or removal of the ACID diversion dam.

18 *Red Bluff Pumping Plant*

19 The Red Bluff Pumping Plant and Fish Screen were completed in August 2012 to
20 replace the Red Bluff Diversion Dam and improve fish passage conditions on the
21 Sacramento River at Red Bluff, California. The facility includes a 1,118-foot-long
22 flat-plate fish screen, intake channel, 2,500 cfs capacity pumping plant and discharge
23 conduit to divert water from the Sacramento River into the Tehama-Colusa and
24 Corning canals.

25 In 2011, the dam gates were permanently placed in the open position for free
26 migration of fish while ensuring continued water deliveries by way of the Red
27 Bluff Pumping Plant.

28 **3A.4.3.2.8 Tehama-Colusa Canal Authority Operations**

29 The intake for the Tehama-Colusa Canal and the Corning Canal is located on the
30 Sacramento River approximately 2 miles southeast of Red Bluff. Water is
31 diverted through fish passage facilities along the Sacramento River and lifted by a
32 2,500 cfs pumping plant into a settling basin for continued conveyance in the
33 Tehama-Colusa Canal and the Corning Canal. Reclamation operates the pumping
34 plant in accordance with BOs issued by USFWS and NMFS specifically for the
35 Red Bluff Pumping Plant.

36 The Tehama-Colusa Canal is a lined canal extending from the settling basin
37 111 miles south from the Red Bluff Pumping Plant and provides irrigation service
38 on the west side of the Sacramento Valley in Tehama, Glenn, Colusa, and
39 northern Yolo counties. Construction of the Tehama-Colusa Canal began in
40 1965, and it was completed in 1980.

1 The Corning Pumping Plant lifts water approximately 56 feet from the screened
2 portion of the settling basin into the unlined, 21 mile-long Corning Canal. The
3 Corning Canal was completed in 1959, to provide water to the CVP contractors in
4 Tehama County that could not be served by gravity from the Tehama-Colusa Canal.
5 The Tehama-Colusa Canal Authority (TCCA) operates both the Tehama-Colusa and
6 Corning canals.

7 **3A.4.3.3 American River Division**

8 Reclamation's Folsom Reservoir, the largest reservoir in the American River
9 watershed, has a capacity of 967 TAF. Folsom Dam, located approximately
10 30 miles upstream from the confluence with the Sacramento River, is operated as
11 a major component of the CVP. The American River Division includes facilities
12 that provide conservation of water on the American River for flood control, fish
13 and wildlife protection, recreation, protection of the Delta from intrusion of saline
14 ocean water, irrigation and M&I water supplies, and hydroelectric power
15 generation. Initially authorized features of the American River Division included
16 Folsom Dam, Lake, and Power Plant; Nimbus Dam and Power Plant, and Lake
17 Natoma.

18 Table 3A.7 provides Reclamation's annual water deliveries for the period
19 2000 through 2010 in the American River Division. The totals reveal an
20 increasing trend in water deliveries over that period. For this EIS under the
21 No Action Alternative, the American River Division water demands are modeled
22 assuming that water users can utilize their full contract/agreement values with
23 average annual deliveries of about 800 TAF per year. However, the American
24 River contractors are not currently using this volume. The modeled deliveries
25 vary depending on modeled annual water allocations. The "present level of
26 American River water demands" has been previously modeled at 325 TAF/year
27 based upon information collected over 10 years ago. The recently completed
28 Urban Water Management Plans (UWMPs) for the American River water users
29 indicate that the current average annual water use is about 500 TAF/year. It is
30 anticipated that due to fast growth and new water agreements, the actual usage (as
31 projected by the UWMPs) could increase to about 650 to 800 TAF/year over the
32 next 10 years, depending upon growth rates and implementation of water demand
33 reduction measures.

1 **Table 3A.7 Annual Water Delivery—American River Division**

Year	Water Delivery (TAF)*
2000	174
2001	223
2002	221
2003	270
2004	266
2005	297
2006	280
2007	113
2008	233
2009	260
2010	125
2011	269
2012	279

2 Notes:

3 * Annual Water Delivery data has been enhanced and the annual totals include CVP
4 contracts, water rights (including water rights for the City of Sacramento), and other
5 deliveries (e.g., Folsom South Canal losses).

6 TAF = thousand acre-feet

7 Releases from Folsom Dam are re-regulated approximately 7 miles downstream
8 by Nimbus Dam. This facility is also operated by Reclamation as part of the
9 CVP. Nimbus Dam creates Lake Natoma, which serves as a forebay for
10 diversions to the Folsom South Canal. This CVP facility serves water to M&I
11 users in Sacramento County. Releases from Nimbus Dam to the American River
12 pass through the Nimbus Power Plant, or, at flows in excess of 5,000 cfs, the
13 spillway gates.

14 Although Folsom Reservoir is the main storage and flood control reservoir on the
15 American River, numerous other small non-federal reservoirs in the upper basin
16 provide hydroelectric generation and water supply. None of the upstream
17 reservoirs have any specific flood control responsibilities. The total upstream
18 reservoir storage above Folsom Reservoir is approximately 820 TAF. Ninety
19 percent of this upstream storage is contained by five reservoirs: French Meadows
20 (136 TAF); Hell Hole (208 TAF); Loon Lake (76 TAF); Union Valley
21 (271 TAF); and Ice House (46 TAF). Reclamation has agreements with the
22 operators of some of these reservoirs to coordinate operations for releases.

23 French Meadows and Hell Hole reservoirs, located on the Middle Fork of the
24 American River, are owned and operated by the Placer County Water Agency
25 (PCWA). The PCWA provides wholesale water to agricultural and urban areas
26 within Placer County. For urban areas, PCWA operates water treatment plants

1 and sells wholesale treated water to municipalities that provide retail delivery to
2 their customers. The cities of Rocklin and Lincoln receive water from PCWA,
3 Loon Lake, and Union Valley and Ice House reservoirs on the South Fork of the
4 American River, are all operated by the Sacramento Municipal Utilities District
5 (SMUD) for hydropower purposes.

6 **3A.4.3.3.1 Flood Control**

7 Flood control requirements and regulating criteria are specified by the USACE
8 and described in the Folsom Dam and Lake, American River, California Water
9 Control Manual (U.S. Army Corps of Engineers 1987). Flood control objectives
10 for the Folsom unit require that the dam and lake be operated to:

- 11 • Protect the City of Sacramento and other areas within the Lower American
12 River floodplain against reasonable probable rain floods.
- 13 • Control flows in the American River downstream from Folsom Dam to
14 existing channel capacities, insofar as practicable, and reduce flooding along
15 the lower Sacramento River and in the Delta in conjunction with other CVP
16 Projects.
- 17 • Provide the maximum amount of water conservation storage without
18 impairing the flood control functions of the reservoir.
- 19 • Provide the maximum amount of power practicable and be consistent with
20 required flood control operations and the conservation functions of the
21 reservoir.

22 From June 1 through September 30, no flood control storage restrictions exist.
23 From October 1 through November 16 and from April 20 through May 31,
24 reserving storage space for flood control is a function of the date only, with full
25 flood reservation space required from November 17 through February 7.
26 Beginning February 8 and continuing through April 20, flood reservation space is
27 a function of both date and current hydrologic conditions in the basin.

28 If the inflow into Folsom Reservoir causes the storage to encroach into the space
29 reserved for flood control, releases from Nimbus Dam are increased. Flood
30 control regulations prescribe the following releases when water is stored within
31 the flood control reservation space.

- 32 • Maximum inflow (after the storage entered into the flood control reservation
33 space) of as much as 115,000 cfs, but not less than 20,000 cfs, when inflows
34 are increasing.
- 35 • Releases would not be increased more than 15,000 cfs or decreased more than
36 10,000 cfs during any two-hour period.
- 37 • Flood control requirements override other operational considerations in the
38 fall and winter period. Consequently, short-term changes in river releases
39 may occur.

1 In February 1986, the American River Basin experienced a significant flood
2 event. Folsom Dam and Folsom Reservoir moderated the flood event and
3 performed the flood control objectives, but with serious operational strains and
4 concerns in the Lower American River and for the overall protection of the
5 communities in the floodplain areas. A similar flood event occurred in January
6 1997. Since then, significant review and enhancement of Lower American River
7 flooding issues have occurred and are ongoing. A major element of those efforts
8 has been the Sacramento Area Flood Control Agency (SAFCA)-sponsored flood
9 control plan diagram for Folsom Reservoir.

10 Since 1996, Reclamation has operated according to modified flood control
11 criteria, which reserve 400 to 670 TAF of flood control space in Folsom Reservoir
12 in combination with three upstream reservoirs. This flood control plan, which
13 provides additional protection for the Lower American River, is implemented
14 through an agreement between Reclamation and SAFCA. The terms of the
15 agreement allow some of the empty reservoir space in Hell Hole, Union Valley,
16 and French Meadows to be treated as if it were available in Folsom Reservoir.

17 The SAFCA release criteria are generally equivalent to the USACE plan, except
18 the SAFCA diagram may prescribe flood releases earlier than the USACE plan.
19 The SAFCA diagram also relies on Folsom Dam outlet capacity to make the
20 earlier flood releases. The outlet capacity at Folsom Dam is currently limited to
21 32,000 cfs based on lake elevation. However, in general the SAFCA plan
22 diagram provides greater flood protection than the existing USACE plan for
23 communities in the American River floodplain.

24 Required flood control space under the SAFCA diagram begin to decrease on
25 March 1. Between March 1 and April 20, the rate of filling is a function of the
26 date and available upstream space. As of April 21, the required flood reservation
27 is about 225 TAF. From April 21 to June 1, the required flood reservation is a
28 function of the date only, with Folsom Reservoir storage permitted to fill
29 completely on June 1.

30 Reclamation and USACE are jointly working on construction of an auxiliary
31 spillway at Folsom Dam that would assist in meeting the established flood
32 damage reduction objectives for the Sacramento area while continuing to preserve
33 and expedite safely passing the Probable Maximum Flood. This project is
34 commonly referred as the Joint Federal Project. Other partners in this project
35 include DWR and SAFCA.

36 USACE (and Reclamation as the National Environmental Policy Act [NEPA]
37 cooperating agency) is also undertaking a Folsom Dam Reoperation Study to
38 develop, evaluate, and recommend changes to the flood control operations of the
39 Folsom Dam project that would further the goal of reduced flood risk for the
40 Sacramento area. Operational changes may be necessary to fully realize the flood
41 risk reduction benefits of the additional operational capabilities created by
42 completion of the Joint Federal Project, and the increased system capabilities
43 provided by the implemented and authorized features of the Common Features

1 Project (a project being carried out by USACE and designed to strengthen the
2 American River levees so they can safely pass a flow of 160,000 cfs); and those
3 anticipated to be provided by completion of the authorized Folsom Dam Mini-
4 Raise Project. The Folsom Dam Reoperation Study would also consider
5 improved forecasts from the National Weather Service. Once a modified flood
6 operation plan is complete, USACE, in cooperation with Reclamation (and DWR
7 as the California Environmental Quality Act [CEQA] lead and SAFCA as the
8 local partner), would consult with USFWS and NMFS relative to any changes to
9 American River and/or system-wide CVP operations that may result.

10 Additional information related to the flood control criteria for Folsom Dam
11 operations is included by reference to documents prepared by the USACE and
12 SAFCA.

13 **3A.4.3.3.2 Fish and Wildlife Requirements in the Lower American River**

14 The minimum allowable flows in the Lower American River are defined by
15 SWRCB Water Right Decision 893 (D 893), which states that, in the interest of
16 fish conservation, releases should not ordinarily fall below 250 cfs between
17 January 1 and September 15 or below 500 cfs at other times. D-893 minimum
18 flows are rarely the controlling objective of CVP operations at Nimbus Dam.
19 Nimbus Dam releases are nearly always controlled during significant portions of a
20 water year by either flood control requirements or are coordinated with other CVP
21 and SWP releases to meet downstream SWRCB WQCP requirements and CVP
22 water supply objectives. Power regulation and management needs occasionally
23 control Nimbus Dam releases. Nimbus Dam releases are expected to exceed the
24 D-893 minimum flows in all but the driest of conditions.

25 In July 2006, Reclamation, the Sacramento Area Water Forum and other
26 stakeholders completed a draft technical report establishing a flow and
27 temperature regime intended to improve conditions for fish in the lower American
28 River (i.e., the Lower American River Flow Management Standard [FMS]).
29 Reclamation began operating to the FMS immediately thereafter. The modeling
30 assumptions herein include the operational components of the minimum Lower
31 American River flows, consistent with the proposed FMS. The Sacramento Area
32 Water Forum is currently investigating a revised FMS to better address
33 temperature concerns on the Lower American River. Environmental compliance
34 documentation is currently in the early stages of development. The FMS flows
35 may be met by releases of water pursuant to Section 3406 (b)(2) of the CVPIA, if
36 necessary.

37 Use of additional (b)(2) flows above the proposed flow standard is envisioned
38 only on a case-by-case basis. Such additional use of (b)(2) flows would be
39 subject to available resources and such use would be coupled with plans to not
40 intentionally cause significantly lower river flows later in a water year. This
41 case-by-case use of additional (b)(2) for minimum flows is not included in the
42 modeling results.

1 Water temperature control operations in the Lower American River are affected
2 by many factors and operational tradeoffs. These include available cold water
3 resources, Nimbus release schedules, annual hydrology, Folsom power penstock
4 shutter management flexibility, Folsom Dam Urban Water Supply TCD
5 management, and Nimbus Hatchery considerations. Shutter and TCD
6 management provide the majority of operational flexibility used to control
7 downstream temperatures.

8 During the late 1960s, Reclamation designed a modification to the trashrack
9 structures to provide selective withdrawal capability at Folsom Dam. Folsom
10 Power Plant is located at the foot of Folsom Dam on the right abutment. Three
11 15-foot-diameter steel penstocks for delivering water to the turbines are
12 embedded in the concrete section of the dam. The centerline of each penstock
13 intake is at elevation 307.0 feet and the minimum power pool elevation is
14 328.5 feet. A reinforced concrete trashrack structure with steel trashracks protects
15 each penstock intake.

16 The steel trashracks, located in five bays around each intake, extend the full
17 height of the trashrack structure (between 281 and 428 feet). Steel guides were
18 attached to the upstream side of the trashrack panels between elevation 281 and
19 401 feet. Forty-five 13-foot steel shutter panels (nine per bay), which are
20 operated by a gantry crane, were installed in these guides to select the level of
21 withdrawal from the reservoir. The shutter panels are attached to one another, in
22 a configuration starting with the top shutter, in groups of three, two, and four.

23 Selective withdrawal capability on the Folsom Dam Urban Water Supply Pipeline
24 (also known as the TCD) became operational in 2003. The centerline to the
25 84-inch-diameter Urban Water Supply intake is at elevation 317 feet. An
26 enclosure structure extending from just below the water supply intake to an
27 elevation of 442 feet was attached to the upstream face of Folsom Dam. A
28 telescoping control gate allows for selective withdrawal of water anywhere
29 between 331 and 401 feet elevation under normal operations.

30 The current objectives for water temperatures in the Lower American River
31 address the needs for steelhead incubation and rearing during the late spring and
32 summer, and for fall-run Chinook Salmon spawning and incubation starting in
33 late October or early November.

34 A major challenge is determining the starting date at which time the objective is
35 met. Establishing the start date requires a balancing between forecasted release
36 rates, the volume of available cold water, and the estimated date at which time
37 Folsom Reservoir turns over and becomes isothermic. Reclamation works to
38 provide suitable spawning temperatures as early as possible (after November 1) to
39 help avoid temperature related pre-spawning mortality of adults and reduced egg
40 viability. Operations are balanced against the possibility of running out of cold
41 water and increasing downstream temperatures after spawning is initiated and
42 creating temperature-related effects on eggs already in the gravel.

1 In any given year at Folsom Reservoir, the available cold water resources needed
2 to meet the stated water temperature goals are often insufficient. Only in wetter
3 hydrologic conditions is the volume of cold water resources available sufficient to
4 meet all the water temperature objectives. Therefore, significant operations
5 tradeoffs and flexibilities are part of an annual planning process for coordinating
6 an operation strategy that realistically manages the limited cold water resources
7 available. Reclamation's coordination on the planning and management of cold
8 water resources is done through the (b)(2)IT and ARG groups discussed above.

9 The management process begins in the spring as Folsom Reservoir fills. All
10 penstock shutters are put in the down position to isolate the colder water in the
11 reservoir below an elevation of 401 feet. The reservoir water surface elevation
12 must be at least 25 feet higher than the sill of the upper shutter (426 feet) to avoid
13 cavitation of the power turbines. The earliest this can occur is in the month of
14 March, due to the need to maintain flood control space in the reservoir during the
15 winter. The pattern of spring run-off is then a significant factor in determining
16 the availability of cold water for later use. Folsom Reservoir inflow temperatures
17 begin to increase and the lake starts to stratify as early as April. By the time the
18 reservoir is filled or reaches peak storage (sometime in the May through June
19 period), the reservoir is highly stratified, with surface waters too warm to meet
20 downstream temperature objectives. There are, however, times during the filling
21 process when use of the spillway gates can be used to conserve cold water.

22 In the spring of 2003, high inflows and encroachment into the allowable storage
23 space for flood control required releases that exceeded the available capacity of
24 the power plant. Under these conditions, Folsom Dam standard operations
25 involve the use of the river outlets that draw upon the cold water pool.
26 Reclamation reviewed the release requirements, Safety of Dams issues, reservoir
27 water temperature conditions, and the cold water pool benefits, and determined
28 that the spillway gates should be used to make the incremental releases above
29 power plant capacity, thereby conserving cold water for later use. The ability and
30 necessity to take similar actions are evaluated on a case-by-case basis.

31 The annual temperature management strategy and challenge is to balance
32 conservation of cold water for later use in the fall with the more immediate needs
33 of steelhead during the summer. The planning and forecasting process for the use
34 of the cold water pool begins in the spring as Folsom Reservoir fills. Actual
35 Folsom Reservoir cold water resource availability becomes significantly more
36 defined through the assessment of reservoir water temperature profiles and more
37 definite projections of inflows and storage. Technical modeling analysis begins in
38 the spring for the projected Lower American River water temperature
39 management plan. The significant variables and key assumptions in the analysis
40 include:

- 41 • Cold Water Pool volume in March
- 42 • Starting reservoir temperature conditions
- 43 • Forecasted inflow and outflow quantities
- 44 • Assumed meteorological conditions

- 1 • Assumed inflow temperatures
- 2 • Assumed Folsom Dam Water Supply Intake TCD operations

3 A series of TCD shutter management scenarios are then incorporated into a model
4 to gain a better understanding of the potential for meeting water temperature
5 needs for both over-summer rearing steelhead and spawning Chinook Salmon in
6 the fall. Most annual strategies contain significant tradeoffs and risks for water
7 temperature management for steelhead and fall-run Chinook Salmon goals and
8 needs due to the frequently limited coldwater resource. The planning process
9 continues throughout the summer. New temperature forecasts and operational
10 strategies are updated as more information on actual operations and ambient
11 conditions is gained.

12 Meeting both the summer steelhead and fall salmon temperature objectives
13 without negatively impacting other CVP project purposes requires the final
14 shutter pull be reserved for use in the fall to provide suitable fall-run Chinook
15 Salmon spawning temperatures. In most years, the volume of cold water is not
16 sufficient to support strict compliance with the summer water temperature target
17 at the downstream end of the compliance reach at the Watt Avenue Bridge; while
18 at the same time reserving adequate water for fall releases to protect fall-run
19 Chinook Salmon, or in some cases, continuing to meet steelhead over-summer
20 rearing objectives later in the summer. A strategy used under these conditions is
21 to allow the annual compliance location water temperatures to warm towards the
22 upper end of the annual water temperature design value before making a shutter
23 pull. This management flexibility is essential to the annual management strategy
24 to extend the effectiveness of cold water management through the summer and
25 fall months.

26 The Folsom Water Supply Intake TCD has provided additional flexibility to
27 conserve cold water for later use. As anticipated, the TCD has been operated
28 during the summer months and delivers water that is slightly warmer than that
29 which could be used to meet downstream temperatures (60°F to 62°F), but not so
30 warm as to cause significant treatment issues.

31 Water temperatures feeding the Nimbus Fish Hatchery were historically too high
32 for hatchery operations during some dry or critical years. Water temperatures in
33 the Nimbus Hatchery are generally in the desirable range of 42°F to 55°F, except
34 for the months of June, July, August, and September. When temperatures get
35 above 60°F during these months, the hatchery must begin to treat the fish with
36 chemicals to prevent disease. When temperatures reach the 60°F to 70°F range,
37 treatment becomes difficult and conditions become increasingly dangerous for the
38 fish. In years when mean daily water temperatures are forecast to approach 70°F,
39 a significant number of steelhead may be released early in the summer. Stocked
40 fish have the opportunity to find suitable rearing habitat within the river and
41 reduced densities result in lower mortality in the group of fish that remain in the
42 hatchery.

1 Reclamation operates Nimbus Dam Fish Hatchery to maintain the health of the
2 hatchery fish while minimizing the loss of the coldwater pool for fish spawning in
3 the river during fall. Evaluation of Nimbus Dam operations is done on a case-by-
4 case basis and is different in various months and year types. Water temperatures
5 above 70°F in the hatchery usually mean the fish need to be moved to another
6 hatchery or released to the river. The real-time implementation of flow objectives
7 and meeting SWRCB D-1641 Delta standards with the limited water resources of
8 the Lower American River requires a significant coordination effort to manage
9 the cold water resources at Folsom Dam and Reservoir. Reclamation consults
10 with USFWS, NMFS, and CDFW through (b)(2)IT when these types of difficult
11 decisions are needed. In addition, Reclamation communicates with the ARG on
12 real-time data and operational tradeoffs.

13 A fish diversion weir at the hatcheries blocks Chinook Salmon from continuing
14 upstream and guides them to the hatchery fish ladder entrance. The fish diversion
15 weir consists of eight piers on 30-foot spacing, including two riverbank
16 abutments. Fish rack support frames and walkways are installed each fall using
17 an overhead cable system. A pipe rack is then put in place to support the pipe
18 pickets (0.75-inch steel rods spaced on 2.5-inch centers). The pipe rack rests on a
19 submerged steel I-beam support frame that extends between the piers and forms
20 the upper support structure for a rock-filled crib foundation. The rock foundation
21 has deteriorated with age and is subject to annual scour, which can leave holes in
22 the foundation that allow fish to pass if left unattended. Reclamation released the
23 final environmental documentation in August 2011 that selected an alternative to
24 extend the existing fishway up to Nimbus Dam as the solution to the issues
25 associated with the weir. Construction of the new fishway is expected to be
26 completed by 2030.

27 Fish rack supports and pickets are installed during early to mid-September of each
28 year to correspond with the beginning of the fall-run Chinook Salmon spawning
29 season. A release equal to or less than 1,500 cfs from Nimbus Dam is required
30 for safety and to provide full access to the fish rack supports. It takes six people
31 approximately 3 days to install the fish rack supports and pickets. In years after
32 high winter flows have caused active scour of the rock foundation, a short period
33 (less than 8 hours) of lower flow (approximately 500 cfs) is needed to remove
34 debris from the I-beam support frames, seat the pipe racks, and fill holes in the
35 rock foundation. Complete installation can take up to 7 days, but is generally
36 completed in less time. The fish rack supports and pickets are usually removed at
37 the end of fall-run Chinook Salmon spawning season (mid-January) when flows
38 are less than 2,000 cfs. If Nimbus Dam releases are expected to exceed 5,000 cfs
39 during the operational period, the pipe pickets are removed until flows decrease.

40 As described previously, Folsom Reservoir also is operated to release water to
41 meet Delta water quality and flow objectives to improve fisheries conditions,
42 including releases for salinity objectives. Weather conditions combined with tidal
43 action can quickly affect Delta salinity conditions, and therefore, the Delta
44 outflow required to maintain joint standards. If, in this circumstance, it is decided

1 the reasonable course of action is to increase upstream reservoir releases, then the
2 response would likely be to increase Folsom Reservoir releases first because the
3 released water would reach the Delta before flows released from other CVP and
4 SWP reservoirs. Lake Oroville water releases require about 3 days to reach the
5 Delta, while water released from Shasta Lake requires 5 days to travel from
6 Keswick Reservoir to the Delta. As water from the other reservoirs arrives in the
7 Delta, Folsom Reservoir releases can be adjusted downward. These operational
8 practices can reduce the amount of water in Folsom Reservoir, especially during a
9 water year with limited snowpack. The water released from Folsom Reservoir
10 cannot be replaced during the late winter and spring months if the snowpack is not
11 adequate. When these conditions occur, there is a possibility of reduced water
12 deliveries to CVP water service contractors that rely solely upon American River
13 water supplies, including El Dorado County Water Agency, El Dorado Irrigation
14 District, Sacramento Municipal Utility District, cities of Roseville and Folsom,
15 PCWA, San Juan Water District, and Sacramento County Water Agency.

16 **3A.4.3.3.3 CVPIA 3406 (b)(2) Operations on the Lower American River**

17 Dedication of (b)(2) water on the American River provides instream flows below
18 Nimbus Dam greater than those that would have occurred under pre-CVPIA
19 regulations, e.g., the fish and wildlife requirements previously mentioned in the
20 American River Division. Instream flow objectives from October through May
21 generally aim to provide suitable habitat for salmon and steelhead spawning,
22 incubation, and rearing, while considering impacts. Instream flow objectives for
23 June to September endeavor to provide suitable flows and water temperatures for
24 juvenile steelhead rearing, while balancing the effects on temperature operations
25 into October and November.

26 *Flow Fluctuation and Stability Concerns*

27 Through CVPIA, Reclamation has funded studies by CDFW to better define the
28 relationships of Nimbus release rates and rates of change criteria in the Lower
29 American River to minimize the negative effects of necessary Nimbus release
30 changes on sensitive fishery objectives. Reclamation is presently using draft
31 criteria developed by CDFW. The draft criteria have helped reduce the incidence
32 of anadromous fish stranding relative to past historic operations.

33 The primary operational coordination for potentially sensitive Nimbus Dam
34 release changes is conducted through the (b)(2)IT process. The ARG is another
35 forum to discuss criteria for flow fluctuations. Since 1996 the group has provided
36 input on a number of operational issues and has served as an aid towards
37 adaptively managing releases, including flow fluctuation and stability, and
38 managing water temperatures in the Lower American River to meet the needs of
39 salmon and steelhead.

1 **3A.4.3.4 Delta Division and West San Joaquin Division**

2 **3A.4.3.4.1 CVP Facilities**

3 The CVP's Delta Division consists of the DCC, the Contra Costa Canal and
4 Pumping Plants, Contra Loma Dam, Martinez Dam, the Jones Pumping Plant
5 (formerly Tracy Pumping Plant), the TFCF, and the DMC. Collectively these
6 facilities divert water for irrigation and M&I use to the San Francisco Bay Area,
7 the Central Valley, and for transport to Southern California. The DCC is a
8 controlled diversion channel between the Sacramento River and Snodgrass
9 Slough. The CCWD diversion facilities use CVP water resources to serve district
10 customers directly and to operate CCWD's Los Vaqueros Project. The Jones
11 Pumping Plant diverts water from the Delta to the head of the DMC.

12 **3A.4.3.4.2 Delta Cross Channel Operations**

13 The DCC is a gated diversion channel in the Sacramento River near Walnut
14 Grove and Snodgrass Slough. Flows into the DCC from the Sacramento River are
15 controlled by two 60-foot by 30-foot radial gates. When the gates are open, water
16 flows from the Sacramento River through the cross channel to channels of the
17 lower Mokelumne and San Joaquin Rivers toward the interior Delta. The DCC
18 operation improves water quality in the interior Delta by improving circulation
19 patterns of good quality water from the Sacramento River towards Delta diversion
20 facilities.

21 Reclamation operates the DCC in the open position to (1) improve the movement
22 of water from the Sacramento River to the export facilities at the Banks and Jones
23 Pumping Plants, (2) improve water quality in the southern Delta, and (3) reduce
24 salt water intrusion rates in the western Delta. During the late fall, winter, and
25 spring, the gates are often periodically closed to protect out migrating salmonids
26 from entering the interior Delta. In addition, whenever flows in the Sacramento
27 River at Sacramento reach 20,000 to 25,000 cfs (on a sustained basis) the gates
28 are closed to reduce potential scouring and flooding that might occur in the
29 channels on the downstream side of the gates.

30 Flow rates through the gates are determined by Sacramento River stage and are
31 not affected by export rates in the south Delta. The DCC also serves as a link
32 between the Mokelumne River and the Sacramento River for small craft, and is
33 used extensively by recreational boaters and fishermen whenever it is open.
34 Because alternative routes around the DCC are quite long, Reclamation tries to
35 provide adequate notice of DCC closures so boaters may plan for the longer
36 excursion.

37 SWRCB D-1641 DCC standards provide for closure of the DCC gates for
38 fisheries protection at certain times of the year. From November through January,
39 the DCC may be closed for up to 45 days for fishery protection purposes. From
40 February 1 through May 20, the gates are closed for fishery protection purposes.
41 The gates may also be closed for 14 days for fishery protection purposes during
42 the May 21 through June 15 time period. Reclamation determines the timing and

1 duration of the closures after discussion with USFWS, CDFW, and NMFS. These
2 discussions occur through WOMT as part of the weekly review of CVP and SWP
3 operations.

4 WOMT typically relies on monitoring for fish presence and movement in the
5 Sacramento River and Delta, the salvage of salmon at the Tracy and Skinner
6 facilities, and hydrologic cues when considering the timing of DCC closures.
7 However, the overriding factors are current water quality conditions in the interior
8 and western Delta. From mid-June to November, Reclamation usually keeps the
9 gates open on a continuous basis. The DCC is also usually opened for the busy
10 recreational Memorial Day weekend, if this is possible from a fishery, water
11 quality, and flow standpoint.

12 The Salmon Decision Process is used by the fishery agencies and Project
13 operators to facilitate the often complex coordination issues surrounding DCC
14 gate operations and the purposes of fishery protection closures, Delta water
15 quality, and/or export reductions. Inputs such as fish life stage and size
16 development, current hydrologic events, fish indicators (such as the Knight's
17 Landing Catch Index and Sacramento Catch Index), and salvage at the export
18 facilities, as well as current and projected Delta water quality conditions, are used
19 to determine potential DCC closures and/or export reductions. The Salmon
20 Decision Process includes "Indicators of Sensitive Periods for Salmon," such as
21 hydrologic changes, detection of spring-run salmon or spring-run salmon
22 surrogates at monitoring sites or the salvage facilities, and turbidity increases at
23 monitoring sites, which trigger the Salmon Decision Process.

24 *Implementation of 2009 National Marine Fisheries Service Biological Opinion*

25 The 2009 NMFS BO RPA Action IV.1.2 requires Reclamation to close the DCC
26 for additional days from October 1 through November 30; December 1 through
27 December 14, unless closures cause adverse impacts on water quality conditions;
28 and December 15 through January 31, if fish are present.

29 **3A.4.3.4.3 Jones Pumping Plant**

30 The CVP and SWP use the Sacramento River, San Joaquin River, and Delta
31 channels to transport water to export pumping plants located in the south Delta.
32 The CVP's Jones Pumping Plant, located about 5 miles north of Tracy, has six
33 available pumps. The Jones Pumping Plant has a permitted diversion capacity of
34 4,600 cfs and sits at the end of an earth-lined intake channel about 2.5 miles long.
35 With the completion of the Delta-Mendota Canal/California Aqueduct Intertie
36 (described under Joint Project Facilities), this capacity is no longer limited. At
37 the head of the intake channel, louver screens (that are part of the TFCF) intercept
38 fish, which are then collected, held, and transported by tanker truck to release
39 sites far away from the pumping plants. The CVP uses two release sites, one on
40 the Sacramento River near Horseshoe Bend and the other on the San Joaquin
41 River immediately upstream of the Antioch Bridge.

1 **3A.4.3.4.4 Tracy Fish Collection Facility**

2 The TFCF is located in the south-west portion of the Delta and uses behavioral
3 barriers consisting of primary and secondary louvers, to guide entrained fish into
4 holding tanks before transport by truck to release sites within the Delta. The
5 TFCF was designed to handle smaller fish (<200 millimeters [mm]) that would
6 have difficulty fighting the strong pumping plant induced flows since the intake is
7 essentially open to the Delta and also impacted by tidal action.

8 The primary louvers are located in the primary channel just downstream of the
9 trashrack structure. The secondary louvers are located in the secondary channel
10 just downstream of the traveling water screen. The louvers allow water to pass
11 through onto the pumping plant but the openings between the slats are tight
12 enough and angled against the flow of water so as to prevent most fish from
13 passing between them and instead enter one of four bypass entrances along the
14 louver arrays.

15 Approximately 52 different species of fish are entrained into the TFCF each year;
16 however, the total numbers are significantly different for the various species
17 salvaged. Also, it is difficult if not impossible to determine exactly how many
18 safely make it all the way to the collection tanks, to be transported back to the
19 Delta. Hauling trucks used to transport salvaged fish to release sites inject oxygen
20 and contain an eight parts per thousand salt solution to reduce stress.

21 When south Delta hydraulic conditions allow, and within the original design
22 criteria for the TFCF, the louvers are operated with the D-1485 objectives of
23 achieving water approach velocities: for striped bass of approximately 1 foot per
24 second (ft/s) from May 15 through October 31, and for salmon of approximately
25 3 feet/second (ft/s) from November 1 through May 14.

26 Fish passing through the facility are sampled at intervals of no less than
27 20 minutes every 2 hours when listed fish are present, generally December
28 through June. When few fish are present, sampling intervals are 10 minutes every
29 2 hours. Fish observed during sampling intervals are identified by species,
30 measured to fork length, examined for marks or tags, and placed in the collection
31 facilities for transport by tanker truck to the release sites in the North Delta away
32 from the pumps. In addition, TFCF personnel monitor for the presence of spent
33 female Delta Smelt in anticipation of expanding the salvage operations to include
34 sub-20 millimeter (mm) larval Delta Smelt detection.

35 CDFW is leading studies of fish survival during the collection, handling,
36 transportation, and release process, examining Delta Smelt injury, stress, survival,
37 and predation. Thus far it has presented initial findings at various interagency
38 meetings (Interagency Ecological Program [IEP], Central Valley Fish Facilities
39 Review Team, and American Fisheries Society) showing relatively high survival
40 and low injury. DWR has concurrently been conducting focused studies
41 examining the release phase of the salvage process including a study examining
42 predation at the point of release and a study examining injury and survival of
43 Delta Smelt and Chinook Salmon through the release pipe. Based on these

1 studies, improvements to release operations and/or facilities, including improving
2 fishing opportunities in Clifton Court Forebay (CCF) to reduce populations of
3 predator fish, are being implemented.

4 CDFW and USFWS evaluated pre-screen loss and facility/louver efficiency for
5 juvenile and adult Delta Smelt at the Skinner Fish Facility of the SWP (described
6 in Section 5, State Water Project). DWR also conducted pre-screen loss and
7 facility efficiency studies for steelhead.

8 **3A.4.3.4.5 Contra Costa Water District Diversion Facilities**

9 The CCWD diverts water from the Delta for irrigation and M&I uses under its
10 CVP contract and under its own water right permits and license, issued by
11 SWRCB. CCWD's water system includes the Mallard Slough, Rock Slough, Old
12 River, and Middle River (on Victoria Canal) intakes; the Contra Costa Canal and
13 shortcut pipeline; and the Los Vaqueros Reservoir. The Rock Slough Intake
14 facilities, the Contra Costa Canal, and the shortcut pipeline are owned by
15 Reclamation, and operated and maintained by CCWD under contract with
16 Reclamation. Reclamation completed construction of a fish screen at the Rock
17 Slough intake in 2011; testing and the transfer of operation and maintenance of
18 the fish screen to CCWD is ongoing. Mallard Slough Intake, Old River Intake,
19 Middle River Intake, and Los Vaqueros Reservoir are owned and operated by
20 CCWD.

21 The Mallard Slough Intake is located at the southern end of a 3,000-foot-long
22 channel running south from Suisun Bay, near Mallard Slough (across from Chippis
23 Island). The Mallard Slough Pump Station was refurbished in 2002, which
24 included constructing a positive barrier fish screen at this intake. The Mallard
25 Slough Intake can pump up to 39.3 cfs. CCWD's water right license and permit
26 (License No. 10514 and Permit No. 19856) authorize diversions of up to
27 26,780 acre-feet per year at Mallard Slough. However, this intake is rarely used
28 due to the generally high salinity at this location. Pumping at the Mallard Slough
29 Intake since 1993 has on average accounted for about 3 percent of CCWD's total
30 diversions. When CCWD diverts water at the Mallard Slough Intake, CCWD
31 reduces pumping of CVP water at its other intakes.

32 The Rock Slough Intake is located about four miles southeast of Oakley, where
33 water flows through a positive barrier fish screen into the earth-lined portion of
34 the Contra Costa Canal. The fish screen at this intake was constructed by
35 Reclamation in accordance with the CVPIA and the 1993 USFWS BO for the Los
36 Vaqueros Project to reduce take of fish through entrainment at the Rock Slough
37 Intake. The Canal connects the fish screen at Rock Slough to Pumping Plant 1,
38 approximately four miles to the west. The Canal is earth-lined and open to tidal
39 influence for approximately 3.7 miles from the Rock Slough fish screen.
40 Approximately 0.3 miles of the Canal immediately east (upstream) of Pumping
41 Plant 1 have been encased in concrete pipe, the first portion of the CCWD's
42 Contra Costa Canal Encasement Project to be completed. When fully completed,
43 the Canal Encasement Project would eliminate tidal flows into the Canal because

1 the encased pipeline would be located below the tidal range elevation. Pumping
2 Plant 1 has capacity to pump up to 350 cfs into the concrete-lined portion of the
3 Canal. Diversions at Rock Slough Intake are typically taken under CVP contract.
4 CCWD may divert approximately 30 percent to 50 percent of its total supply
5 through the Rock Slough Intake depending upon water quality there.

6 Construction of the Old River Intake was completed in 1997 as a part of the
7 Los Vaqueros Project. The Old River Intake is located on Old River near State
8 Route 4. The intake has a positive-barrier fish screen and a pumping capacity of
9 250 cfs, and can pump water via pipeline either to the Contra Costa Canal or to
10 Los Vaqueros Reservoir. Diversions at Old River to the Contra Costa Canal are
11 typically taken under CVP contract. Pumping to storage in Los Vaqueros
12 Reservoir is limited to 200 cfs by the terms of the Los Vaqueros Project BOs and
13 by SWRCB Decision 1629, SWRCB water right decision for the Los Vaqueros
14 Project (Permit 20749). Diversions to storage in Los Vaqueros Reservoir are
15 typically taken under CVP contract or under the Los Vaqueros water right permit.
16 The CCWD's water diversions that are not made at Rock Slough diverted at the
17 Middle River and Old River intakes, as determined primarily by the CCWD water
18 quality goals, described below.

19 In 2010, CCWD completed construction of the Middle River Intake (formerly
20 referred to as Alternative Intake Project) on Victoria Canal. The Middle River
21 Intake has a capacity of 250 cfs capacity, with positive-barrier fish screens and a
22 conveyance pipeline to CCWD's existing conveyance facilities. Similar to the
23 Old River Intake, the Middle River Intake can be used either to pump to the
24 Contra Costa Canal or to fill the Los Vaqueros Reservoir. Diversions to the
25 Contra Costa Canal are typically taken under CVP contract, while diversions to
26 storage in the Los Vaqueros Reservoir can be taken either under CVP contract or
27 under CCWD's Los Vaqueros water right (Permit 20749). The effects of the
28 Middle River Intake on Delta Smelt are covered by the April 27, 2007 USFWS
29 BO (amended on May 16, 2007). Effects on salmonids and Green Sturgeon are
30 covered by the July 13, 2007 NMFS BO for this intake project.

31 CCWD operates the Middle River Intake together with its other intake facilities to
32 meet its delivered water quality goals and to protect listed species. The choice of
33 which intake to use at any given time is based in large part upon salinity at the
34 intakes, consistent with fish protection requirements in the BOs for the Middle
35 River Intake and the Los Vaqueros Project. The Middle River Intake was built as
36 a project to improve the water quality delivered to the CCWD service area, and
37 does not increase CCWD's average annual diversions from the Delta. However, it
38 can alter the timing and pattern of CCWD's diversions, because Middle River
39 Intake salinity tends to be lower in the late summer and fall than salinity at
40 CCWD's other intakes. This allows CCWD to decrease winter and spring
41 diversions while still meeting water quality goals in the summer and fall through
42 use of the new intake.

43 Los Vaqueros Reservoir is an off-stream reservoir in the Kellogg Creek watershed
44 to the west of the Delta. Originally constructed as a 100 TAF reservoir in 1997 as

1 part of the Los Vaqueros Project, the facility is used to improve delivered water
2 quality and emergency storage reliability for CCWD's customers. Los Vaqueros
3 Reservoir is filled with Delta water from either the Old River Intake or the Middle
4 River Intake, when salinity in the Delta is low. When Delta salinity is high,
5 typically in the fall months, CCWD releases low salinity water from Los
6 Vaqueros Reservoir to blend with direct diversions from the Delta to meet CCWD
7 water quality goals. Releases from Los Vaqueros Reservoir are conveyed to the
8 Contra Costa Canal via a pipeline.

9 In 2012, Los Vaqueros Reservoir was expanded from 100 TAF to a total storage
10 capacity of 160 TAF to provide additional water quality and water supply
11 reliability benefits, and maintain the initial functions of the reservoir. With the
12 expanded reservoir, CCWD's average annual diversions from the Delta remain
13 the same as they were with the 100 TAF reservoir. A feasibility study is ongoing
14 to evaluate whether an additional expansion of this reservoir is in the federal
15 interest.

16 CCWD diverts approximately 127 TAF per year in total. Approximately
17 110 TAF is CVP contract supply. In winter and spring months when the Delta is
18 relatively fresh (generally January through July), deliveries to the CCWD service
19 area are made by direct diversion from the Delta. In addition, when salinity is
20 low enough, Los Vaqueros Reservoir is filled at a rate of up to 200 cfs from the
21 Old River Intake and Middle River Intake. The BOs for the Los Vaqueros
22 Project, CCWD's Incidental Take Permit issued by CDFW, and SWRCB D-1629
23 include fisheries protection measures consisting of a 75-day period during which
24 CCWD does not fill Los Vaqueros Reservoir and a concurrent 30-day period
25 during which CCWD halts all diversions from the Delta, provided that
26 Los Vaqueros Reservoir storage is above emergency levels. The default dates for
27 the no-fill and no-diversion periods are March 15 through May 31 and April 1
28 through April 30, respectively. USFWS, NMFS, and CDFW can change these
29 dates to best protect the subject species. CCWD coordinates the filling of Los
30 Vaqueros Reservoir with Reclamation and DWR to avoid water supply impacts
31 on other CVP and SWP customers. During the no-diversion period, CCWD
32 customer demand is met by releases from Los Vaqueros Reservoir.

33 In addition to the existing 75-day no-fill period (March 15 to May 31) and the
34 concurrent no-diversion 30 day period, CCWD operates to an additional term in
35 the Incidental Take Permit issued by CDFW. Under this term, CCWD shall not
36 divert water to storage in Los Vaqueros Reservoir for 15 days from February 14
37 through February 28, provided that reservoir storage is at or above 90 TAF on
38 February 1. If reservoir storage is at or above 80 TAF on February 1, but below
39 90 TAF, CCWD shall not divert water to storage in Los Vaqueros Reservoir for
40 10 days from February 19 through February 28. If reservoir storage is at or above
41 70 TAF on February 1, but below 80 TAF, CCWD shall not divert water to
42 storage in Los Vaqueros Reservoir for 5 days from February 24 through
43 February 28. These dates can be changed to better protect Delta fish species, at
44 the direction of CDFW.

1 CCWD’s operation of the diversion, storage, and conveyance facilities to divert
2 water under CCWD’s water rights meets the permitting requirements of the ESA
3 through BOs issued by USFWS and NMFS that are specific to the CCWD system.
4 The NMFS BO issued on March 18, 1993 and USFWS BO issued on
5 September 9, 1993 address the operation of the Los Vaqueros Project, including
6 the Los Vaqueros Reservoir and the Mallard Slough, Rock Slough, and Old River
7 intakes. NMFS BO 2005/00122 issued on July 13, 2007, and USFWS BO issued
8 on April 27, 2007 and amended on May 16, 2007, address the Middle River
9 Intake operations. Concurrence that expansion of Los Vaqueros Reservoir to
10 160 TAF is not likely to adversely affect listed Delta fish species was provided by
11 NMFS on October 15, 2010 and USFWS on November 1, 2010.

12 **3A.4.3.4.6 Water Demands—Delta Mendota Canal and San Luis Unit**

13 Water demands for the DMC and San Luis Unit are primarily composed of three
14 separate types: CVP water service contractors, exchange contractors, and wildlife
15 refuge contractors. Distinct relationships exist between Reclamation and each of
16 these three groups. Exchange contractors “exchanged” their senior rights to water
17 in the San Joaquin River for a CVP water supply generally provided from the
18 Delta. Reclamation thus guaranteed the exchange contractors a firm water supply
19 from the Delta or the San Joaquin River of 840 TAF per annum, with a maximum
20 reduction under the Shasta critical year criteria to an annual water supply of
21 650 TAF.

22 Conversely, water service contractors do not have water rights senior to CVP.
23 Agricultural water service contractors also receive their supply from the Delta, but
24 their supplies are subject to the availability of CVP water supplies that can be
25 developed and reductions in contractual supply can be as high as 100 percent.
26 The CVP also contracts with refuges to provide water supplies to specific
27 managed lands for wildlife purposes. These contracts may be reduced under
28 Shasta critical year criteria up to 25 percent.

29 To achieve the best operation of the CVP, it is necessary to combine the
30 contractual demands of these three types of contractors to achieve an overall
31 pattern of requests for water. In most years, sufficient supplies are not available
32 to meet all water demands because of reductions in CVP water supplies due to
33 restricted Delta pumping capability. In some dry or critically dry years, water
34 deliveries are limited because there is insufficient storage in northern CVP
35 reservoirs to meet all instream fishery objectives, including water temperatures,
36 and to make additional water deliveries via the Jones Pumping Plant. The
37 scheduling of water demands, together with the scheduling of the releases of
38 water supplies from the northern CVP to meet those demands, is a CVP
39 operational objective that is intertwined with the Trinity, Sacramento, and
40 American River operations.

41 **3A.4.3.4.7 CVPIA 3406 (b)(2) Operations in the Delta**

42 Export curtailments at the CVP Jones Pumping Plant and increased CVP reservoir
43 releases required to meet SWRCB D-1641, as well as direct export reductions for

1 fishery management using dedicated (b)(2) water at the CVP Jones Pumping
2 Plant, is determined in accordance with the Interior Decision on Implementation
3 of Section 3406 (b)(2) of the CVPIA. Direct Jones Pumping Plant export
4 curtailments for fishery management protection is based on coordination with the
5 weekly (b)(2)IT meetings and vetted through WOMT, as necessary.

6 **3A.4.3.4.8 Implementation of 2008 USFWS and 2009 NMFS Biological**
7 **Opinions**

8 The 2008 USFWS BO and the 2009 NMFS BO restrict CVP and SWP diversions
9 to reduce reverse flows in Old and Middle rivers (OMR). The 2008 USFWS BO
10 also includes criteria for fall Delta outflow. The 2009 NMFS BO includes criteria
11 for a San Joaquin River I:E ratio (Action IV.2.1), and additional criteria for
12 closure of the Delta Cross Channel Gates.

13 *2008 USFWS BO OMR Criteria*

14 The 2008 USFWS BO limits reverse OMR flows as prescribed in the following
15 three actions.

- 16 • Action 1: to protect adult Delta Smelt migration and entrainment. Limits
17 exports so that the average daily OMR flow is no more negative than -
18 2,000 cfs for a total duration of 14 days, with a 5-day running average no
19 more negative than -2,500 cfs (within 25 percent).
 - 20 – December 1 to December 20 – Based upon turbidity data from turbidity
21 stations (Prisoner’s Point, Holland Cut, and Victoria Canal) and salvage
22 data from CVP and SWP fish handling facilities at the south Delta intakes,
23 and other parameters important to the protection of Delta Smelt including,
24 but not limited to, preceding conditions of X2, Fall Midwater Trawl
25 (FMWT) Survey, and river flows.
 - 26 – After December 20 – The action would begin if the 3 day average
27 turbidity at Prisoner’s Point, Holland Cut, and Victoria Canal exceeds
28 12 nephelometric turbidity units (NTU).
 - 29 – Triggers are based on:
 - 30 ○ Three-day average of 12 NTU or greater at all three turbidity stations;
31 or
 - 32 ○ Three days of Delta Smelt salvage after December 20 at either facility
33 or cumulative daily salvage count that is above a risk threshold based
34 upon the “daily salvage index” approach reflected in a daily salvage
35 index value of greater than or equal to 0.5 (daily Delta Smelt salvage is
36 greater than one-half prior year FMWT index value). The window for
37 triggering Action 1 concludes when either off-ramp condition
38 described below is met. These off-ramp conditions may occur without
39 Action 1 ever being triggered. If this occurs, then Action 3 is
40 triggered, unless the Service concludes on the basis of the totality of
41 available information that Action 2 should be implemented instead.

- 1 – Action 1 offramps when water temperature reaches 12 degrees Celsius
2 (°C) based on a three station daily mean at the temperature stations:
3 Mossdale, Antioch, and Rio Vista; or the onset of spawning based upon
4 the presence of spent females in the Spring Kodiak Trawl Survey or at the
5 CVP or SWP fish handling facilities.
- 6 • Action 2: to protect adult Delta Smelt migration and entrainment. An action
7 implemented using an adaptive process to tailor protection to changing
8 environmental conditions after Action 1. As in Action 1, the intent is to
9 protect pre-spawning adults from entrainment and, to the extent possible, from
10 adverse hydrodynamic conditions. The range of net daily OMR flows would
11 be no more negative than -1,250 to -5,000 cfs. Depending on extant
12 conditions, specific OMR flows within this range are recommended by the
13 USFWS Smelt Working Group (SWG) from the onset of Action 2 through its
14 termination. The SWG would provide weekly recommendations based upon
15 review of the sampling data, from real-time salvage data at the CVP and SWP,
16 and utilizing most up-to-date technological expertise and knowledge relating
17 population status and predicted distribution to monitored physical variables of
18 flow and turbidity. The USFWS makes the final determination.
- 19 – Action 2 begins immediately following Action 1. If Action 1 is not
20 implemented based upon triggers, the SWG may recommend a start date
21 for Action 2.
- 22 – Action 2 is suspended when whenever a 3-day flow average is greater than
23 or equal to 90,000 cfs in Sacramento River at Rio Vista and 10,000 cfs in
24 San Joaquin River at Vernalis. Once such flows have abated, the OMR
25 flow requirements of Action 2 are restarted.
- 26 – Offramps for Action 2 are related to water temperature reaches 12°C
27 based on a three-station daily average at the temperature stations: Rio
28 Vista, Antioch, and Mossdale; or the onset of spawning based upon the
29 presence of a spent female in the Spring Kodiak Trawl Survey or at the
30 CVP or SWP fish handling facilities.
- 31 • Action 3: to protect larval and juvenile Delta Smelt. Minimize the number of
32 larval Delta Smelt entrained at the facilities by managing the hydrodynamics
33 in the Central Delta flow levels pumping rates spanning a time sufficient for
34 protection of larval Delta Smelt. Net daily OMR flow would be no more
35 negative than -1,250 to -5,000 cfs based on a 14-day running average with a
36 simultaneous 5-day running average within 25 percent of the applicable
37 requirement for OMR. Depending on extant conditions, specific OMR flows
38 within this range are recommended by the SWG from the onset of Action 3
39 through its termination.
- 40 – Action 3 begins when temperature reaches 12°C based on a three-station
41 average at the temperature stations: Mossdale, Antioch, and Rio Vista; or
42 onset of spawning based upon the presence of a spent female in the Spring
43 Kodiak Trawl Survey or at the CVP or SWP fish handling facilities.

Appendix 3A: No Action Alternative: Central Valley Project
and State Water Project Operations

- 1 – Action 3 offramps by June 30; or if water temperature reaches a daily
2 average of 25°C for three consecutive days 10 at Clifton Court Forebay.

3 *2009 NMFS BO OMR Criteria*

4 The 2009 NMFS BO includes OMR criteria (Action IV.2.3) to protect juvenile
5 salmonids during winter and spring emigration downstream into the San Joaquin
6 River, and to increase survival of salmonids and Green Sturgeon entering the San
7 Joaquin River from Georgiana Slough and the lower Mokelumne River by
8 reducing the potential for entrainment at the south Delta intakes. The action is
9 implemented from January 1 through June 15 to limit negative flows to -2,500
10 to -5,000 cfs in Old and Middle Rivers, depending on the presence of salmonids.
11 The reverse flow would be managed within this range to reduce flows toward the
12 pumps during periods of increased salmonid presence. The negative flow
13 objective within the range shall be determine based on the following decision tree:

Date	Action Triggers	Action Responses
January 1 – June 15	January 1 – June 15	-5,000 cfs
January 1 – June 15 First Stage Trigger (increasing level of concern)	Daily SWP/CVP older juvenile loss density (fish per TAF) 1) is greater than incidental take limit divided by 2000, with a minimum value of 2.5 fish per TAF, or 2) daily loss is greater than daily measured fish density divided by 12 TAF, or 3) Coleman National Fish Hatchery coded wire tag late-fall run or Livingston Stone National Fish Hatchery coded wire tag winter-run cumulative loss greater than 0.5%, or 4) daily loss of wild steelhead (intact adipose fin) is greater than the daily measured fish density divided by 12 TAF.	-3,500 cfs for minimum of 5 days; and up to -5,000 cfs other times
January 1 – June 15 Second Stage Trigger (analogous to high concern level)	Daily SWP/CVP older juvenile loss density (fish per TAF) is 1) greater than incidental take limit divided by 1000, with a minimum value of 2.5 fish per TAF, or 2) daily loss is greater than daily fish density divided by 8 TAF, or 3) Coleman National Fish Hatchery coded wire tag late-fall run or Livingston Stone National Fish Hatchery coded wire tag winter-run cumulative loss greater than 0.5%, or 4) daily loss of wild steelhead (intact adipose fin) is greater than the daily measured fish density divided by 8 TAF.	-2,500 cfs for minimum of 5 days; and up to -5,000 cfs other times
End of Triggers	Continue action until June 15 or until average daily water temperature at Mossdale is greater than 72°F (22°C) for 7 consecutive days (1 week), whichever is earlier.	No OMR restriction.

1 *2009 NMFS BO San Joaquin River Inflow:Export Ratio*

2 The 2009 NMFS BO Action IV.2.1 requires south Delta exports to be reduced
3 during April and May to protect emigrating steelhead from the lower San Joaquin
4 River into the south Delta channels and intakes. The inflow:export ratio from
5 April 1 through May 31 specifies that Reclamation operates the New Melones
6 Reservoir to maintain the 2009 NMFS BO flow schedule for the Stanislaus River
7 at Goodwin in accordance with Action III.1.3 and Appendix 2-E of the BO. In
8 addition, the CVP and SWP pumps are operated to meet the following ratios,
9 based upon a 14-day running average.

San Joaquin Valley Classification	San Joaquin River flow at Vernalis (cfs):CVP and SWP combined export ratio (cfs)
Critically dry	1:1
Dry	2:1
Below normal	3:1
Above normal	4:1
Wet	4:1
Vernalis flow equal to or greater than 21,750 cfs	Unrestricted exports until flood recedes below 21,750 cfs.

10 During multiple dry years, the ratio would be limited to 1:1 if the New Melones
11 Index related to storage is less than 1,000 TAF and the sum s of the “indicator”
12 numbers established for water year classifications in SWRCB D-1641 (based on
13 the San Joaquin Valley 60-20-20 Water Year Classification in SWRCB D-1641)
14 is greater than 6 for the past two years and the current year. The indicator
15 numbers are 1 for a critically dry year, 2 for a dry year, 3 for a below normal year,
16 4 for an above normal year, and 5 for a wet year.

17 Implementation of the inflow:export ratio under all conditions would allow a
18 minimum pumping rate of 1,500 cfs to meet public health and safety needs of
19 communities that solely rely upon water diverted from the CVP and SWP
20 pumping plants.

21 *2008 USFWS BO Fall X2 Criteria*

22 The 2008 USFWS BO also includes an additional Delta salinity requirement in
23 September through November in wet and above normal water years (Action 4).
24 This requirement is frequently referred to as “Fall X2.” The action requires that
25 in September and October, 2 Practical Salinity Units (psu) salinity is maintained
26 at 74 kilometers (km) during wet years, and 81 km during above normal water
27 years when the preceding year was wet or above normal based upon the
28 Sacramento Basin 40-30-30 index in the SWRCB D-1641. In November of these
29 years, there is no specific X2 requirement, however there is a requirement that all
30 inflow into SWP and CVP upstream reservoirs be conveyed downstream to
31 augment delta outflow to maintain X2 at the locations in September and October.

1 If storage increases during November under this action, the increased storage
2 volume is to be released in December in addition to the requirements under
3 SWRCB D-1641 net Delta Outflow Index.

4 **3A.4.3.5 East Side Division**

5 The East Side Division encompasses the Stanislaus and San Joaquin River
6 Systems and includes New Melones Dam, Tulloch Dam, Goodwin Dam, and
7 smaller Diversion Dams and associated Reservoirs.

8 **3A.4.3.5.1 Factors Influencing New Melones Operations**

9 The Stanislaus River originates in the western slopes of the Sierra Nevada and
10 drains a watershed of approximately 900 square miles. The average unimpaired
11 runoff in the basin is approximately 1.2 MAF per year; the median historical
12 unimpaired runoff is 1.1 MAF per year. Snowmelt from March through early
13 July contributes the largest portion of the flows in the Stanislaus River, with the
14 highest runoff occurring in the months of April, May, and June. New Melones
15 Reservoir is located approximately 60 miles upstream from the confluence of the
16 Stanislaus River and the San Joaquin River.

17 *Water Development Prior to Federal Actions*

18 Agricultural water supply development in the Stanislaus River watershed began in
19 the 1850s and has significantly altered the basin's hydrologic conditions. Prior to
20 1856, the San Joaquin Water Company constructed a diversion dam on the
21 Stanislaus River immediately downstream of the present day location of Tulloch
22 Dam and used the diversion dam to distribute water for irrigation and other uses
23 in the Knights Ferry Area. Beginning in 1856, a series of water and power
24 companies constructed several water supply and power facilities in the Stanislaus
25 River watershed.

26 The San Joaquin Water Company was sold to the Tulloch family in the late
27 1800s, and in 1910, Oakdale Irrigation District (OID) and South San Joaquin
28 Irrigation District (SSJID) bought the Tulloch water rights and physical
29 distribution system. In 1913, OID and SSJID jointly constructed Goodwin
30 Diversion Dam, an 80-foot tall double concrete arch dam, to divert Stanislaus
31 River water (up to 1,816.6 cfs daily) into their respective canals for distribution
32 into their respective service areas for irrigation. Despite its height, Goodwin
33 Diversion Dam is a re-operating reservoir, not a storage reservoir, because a full
34 reservoir is needed to allow diversion to these canals.

35 To address their lack of storage, OID and SSJID joined with The Pacific Gas and
36 Electric Company (PG&E) in 1925 to construct the Melones Dam and
37 Powerhouse (110 TAF capacity) approximately 12.3 river miles upstream of the
38 Goodwin Diversion Dam. Water released from Melones was diverted at Goodwin
39 Diversion Dam for delivery into OID and SSJID's distribution systems.

40 In 1955, OID and SSJID agreed to construct three new facilities, including the
41 Donnells Dam and Reservoir (64,500 TAF capacity) and Beardsley Dam and
42 Reservoir (97.5 TAF capacity) upstream of Melones Dam, and the Tulloch Dam

1 and Reservoir (54.663 TAF capacity), downstream of Melones Dam.
2 Construction of the three facilities, collectively referred to as the Tri-Dam Project,
3 was completed in 1957 and the facilities became operational in 1958. As part of
4 the construction of the Tri-Dam project, Goodwin Diversion Dam was raised to
5 create an afterbay to regulate discharge from Tulloch. From 1985–1990, the
6 Calaveras County Water District constructed the North Fork Stanislaus
7 Hydroelectric Project, which included the construction of New Spicer Reservoir
8 (189 TAF capacity) in 1989. This was a joint development project by Northern
9 California Power Agency (NCPA) and Calaveras County Water District.
10 Calaveras County Water District is the licensee and NCPA is the project operator.

11 Twenty ungauged tributaries contribute flow to the lower portion of the Stanislaus
12 River below Goodwin Dam. These streams provide intermittent flows, occurring
13 primarily during the months of November through April. Agricultural return
14 flows, as well as operational spills from irrigation canals receiving water from
15 both the Stanislaus and Tuolumne Rivers, enter the lower portion of the Stanislaus
16 River. In addition, a portion of the flow in the lower reach of the Stanislaus River
17 originates from groundwater accretions. There are also approximately 48 TAF of
18 annual riparian water rights in the Stanislaus River downstream of Goodwin Dam.

19 *Federal Water Development*

20 In the Flood Control Act of December 1944, Congress authorized construction of
21 a dam to replace Melones Dam to help alleviate serious flooding problems along
22 the Stanislaus and Lower San Joaquin Rivers. In the Flood Control Act of
23 October 1962, Congress reauthorized the project, and expanded it to be a
24 multipurpose facility to be built by USACE and operated by the Secretary of the
25 Interior as the New Melones Unit of the Eastside Division of the CVP. Dam and
26 reservoir construction began in 1966 and, after being halted from 1972 to 1974,
27 was completed by USACE in 1978, with a storage capacity of 2.4 MAF.

28 In 1972, Reclamation applied for the assignment of two state-filed water rights
29 and two new water rights for the New Melones Project. These applications were
30 protested by several parties and mostly resolved through protest settlement
31 agreements. In 1973, SWRCB Decision 1422 (D-1422) initially approved less
32 than 600 TAF in storage for power, senior water rights, water quality, and fish
33 and wildlife protection and enhancement, citing a lack of demonstrated demand
34 and protection of upstream recreation as a reason not to grant consumptive use
35 rights for new demands without further demonstration of a demand for this water.

36 To demonstrate the consumptive use demands, in 1980 Reclamation produced a
37 Stanislaus River Water Allocation and an EIS for the proposed water allocation of
38 the New Melones Unit. The documents describe preferred and alternative
39 boundaries of the Stanislaus River Basin, the anticipated project yield for 2020
40 conditions, the current and anticipated future needs of such basin, the
41 determination of an available “interim” supply until the full buildup of in-basin
42 needs, and an anticipated “firm yield” once full in-basin demand was established.
43 The ROD described that New Melones Reservoir would generate a water supply
44 yield of 230 TAF in 2000, and 180 TAF in 2020; assuming maximum annual

1 releases of 70 TAF for water quality and 98 TAF for downstream fishery. For the
2 interim supply, 85 TAF would be available in the year 2000, diminishing to zero
3 at full in-basin demand. For the firm supply, the Secretary determined that there
4 would be 49 TAF available in 2020 after in-basin demands were met. In 1983,
5 Reclamation entered into a long-term water service contract with Central San
6 Joaquin Water Conservation District for 49 TAF of firm supply and an interim
7 supply of 31 TAF, and a long-term water service contract totaling 75 TAF of
8 interim water with Stockton East Water District (SEWD). Reclamation then
9 successfully applied to have D-1422 amended to allow up to full storage for
10 demonstrated power and consumptive use demands in the same year, and New
11 Melones briefly filled to its capacity of 2.4 MAF for the first time.

12 In 1984, Reclamation applied for the assignment of the direct diversion portion of
13 one of the state water right filings, to be able to serve contracts water at times
14 when New Melones is filling. The application was again protested, with protests
15 largely settled through protest settlement agreements. The direct diversion right
16 was granted in D-1616 in 1988. D-1616 continued water quality requirements
17 and included a new fish and wildlife protest settlement agreement. A later
18 revision added a requirement to study downstream steelhead/trout needs.

19 In 1995 and in 2000, water rights decisions related to updates of the San
20 Francisco Bay/Sacramento–San Joaquin River Delta Water Quality Control Plan
21 (WQCP) added flow requirements at Vernalis and partial responsibility for
22 interior Delta water quality to CVP water rights.

23 *Flood Control*

24 The New Melones Reservoir flood control operation is coordinated with the
25 operation of Tulloch Reservoir. The flood control objective is to maintain flood
26 flows at the Orange Blossom Bridge at less than 8,000 cfs. When possible,
27 however, releases from Tulloch Dam are maintained at levels that would not
28 result in long-term downstream flows in excess of 1,500 cfs because of the past
29 reported potential for seepage in agricultural lands adjoining the river associated
30 with flows above this level. Up to 450 TAF of the 2.4 MAF storage volume in
31 New Melones Reservoir is dedicated for flood control and 10 TAF of Tulloch
32 Reservoir storage is set aside for flood control. Based upon the flood control
33 diagrams prepared by USACE, part or all of the dedicated flood control storage
34 may be used for conservation storage (storing allocated, excess waters),
35 depending on the time of year and the current flood hazard.

36 *Current Water Rights Requirements for New Melones Operations*

37 The operating criteria for New Melones Reservoir are constrained by water rights
38 requirements, flood control operations, contractual obligations, and federal
39 requirements under the ESA and CVPIA.

40 Terms and conditions of Reclamation's water rights define the limitations within
41 which Reclamation can directly divert water or divert water to storage, after
42 senior water rights and in-basin demands are met. Senior water rights are both
43 current and future upstream water right holders (whose priority is reserved in

1 D-1422 and D-1616 and through protest settlement agreements with Tuolumne
2 and Calaveras Counties), and current downstream water right holders and riparian
3 rights (whose priorities are either senior to Reclamation or senior to appropriative
4 rights in general, respectively). In-basin, instream demands include water quality
5 and flow in the lower Stanislaus River and in part in the lower San Joaquin River
6 and Delta (in that the Stanislaus River contributes to these systems). Downstream
7 demands are first met, to the degree possible, by bypassing natural inflow through
8 New Melones Reservoir. When natural flow is insufficient, stored water is
9 released to meet demands specified either through calculated riparian demand,
10 downstream instream objectives, or protest settlement agreements. Whenever
11 possible, multiple demands are met with the same flow.

12 *Senior Water Rights: Protest Settlement Agreements*

13 Reclamation's application for assignment of state water right filings in the early
14 1970s was protested by future in-basin users, senior water rights holders, and the
15 CDFW. To resolve the senior water rights' protest, Reclamation entered into a
16 1972 Agreement and Stipulation with OID, and SSJID. The 1972 Agreement and
17 Stipulation specifies that it satisfies the yield for consumptive purposes of the
18 OID and SSJID water rights on the Stanislaus River, through the provision of up
19 to a maximum of 654 TAF per year of either natural inflow to New Melones
20 Reservoir or water stored in New Melones for diversion at Goodwin Dam for
21 direct use by OID and SSJID and for storage in Woodward Reservoir (36 TAF
22 capacity).

23 In 1988, following a year of low inflow to New Melones Reservoir, the
24 Agreement and Stipulation among Reclamation, OID, and SSJID was
25 renegotiated, resulting in an agreement that depended less on actual inflow and
26 more on Reclamation's storage in New Melones, in order to provide a more
27 reliable, albeit slightly smaller maximum, supply. The 1988 agreement commits
28 Reclamation to provide water in accordance with a formula based on inflow and
29 storage of up to 600 TAF each year for diversion at Goodwin Dam by OID and
30 SSJID to meet their demands. The 1988 Agreement and Stipulation created a
31 "conservation account" in which the difference between the entitled quantity and
32 the actual quantity diverted by OID and SSJID in a year may be carried over for
33 use in subsequent years, depending on storage/flood control conditions in New
34 Melones. This conservation account has a maximum volume of 200 TAF, and
35 withdrawals are constrained by criteria in the agreement.

36 *In-Basin Requirements: Fish and Wildlife in the Lower Stanislaus River*

37 Based on a protest settlement agreement between Reclamation and CDFW,
38 SWRCB D-1422 required Reclamation to bypass or release 98 TAF of water per
39 year (69 TAF in critical years) through New Melones Reservoir to the Stanislaus
40 River on a distribution pattern to be specified each year by CDFW for fish and
41 wildlife purposes. Based on a second protest settlement agreement in 1987,
42 SWRCB D-1616 as amended required increased releases from New Melones to
43 enhance fishery resources for an interim period, during which habitat

1 requirements were to be better defined and a study of Chinook Salmon fisheries
2 on the Stanislaus River would be completed.

3 During the study period, releases for instream flows were to range from 98.3 to
4 302.1 TAF per year. The exact quantity to be released each year was to be
5 determined based on a formulation involving storage, projected inflows, projected
6 water supply, water quality demands, projected CVP contractor demands, and
7 target carryover storage. Because of dry hydrologic conditions during the 1987 to
8 1992 drought period, the ability to provide increased releases was limited.
9 USFWS published the results of a 1993 study, which recommended a minimum
10 instream flow on the Stanislaus River of 155.7 TAF per year for spawning and
11 rearing (Aceituno 1993).

12 The study period is near completion with all but one study (outlined in the 1987
13 agreement) completed at the time of this document. Once this study period is
14 completed, Reclamation is required to present the SWRCB with a revised plan of
15 operations that incorporates the findings from the studies. This new plan is
16 explained below and will replace the former CDFW downstream release
17 requirements.

18 *In-Basin Requirements: Fish and Wildlife in the Lower San Joaquin River*
19 SWRCB D-1641 conditioned CVP water rights to meet flow requirements on the
20 San Joaquin River at Vernalis from February to June to the extent possible. These
21 flows are summarized in Table 3A.8.

22 **Table 3A.8 San Joaquin Base Flows-Vernalis**

Water Year Class	February–June Flow (cfs)*
Critical	710–1,140
Dry	1,420–2,280
Below Normal	1,420–2,280
Above Normal	2,130–3,420
Wet	2,130–3,420

23 Note:
24 *The higher flow required when X2 is required to be at or west of Chipps Island.

25 *In-Basin Requirements: Water Quality in the Lower Stanislaus River*
26 Reclamation’s New Melones water rights require that water be bypassed through
27 or released from New Melones Reservoir to maintain applicable dissolved oxygen
28 (DO) standards to protect the salmon fishery in the Stanislaus River. The 2004
29 San Joaquin Basin 5C Plan (Central Valley Regional Water Quality Control
30 Board) designates the lower Stanislaus River with cold water and spawning
31 beneficial uses, which have a general water quality objective of no less than
32 7 mg/L DO. This objective is therefore applied through the water rights to the
33 Stanislaus River near Ripon.

1 Although not part of the No Action Alternative, Reclamation is evaluating studies
2 to support moving the DO compliance point upstream to Orange Blossom Bridge.
3 The location would better correspond to steelhead rearing in the spring and
4 summer months. If movement of the DO compliance point appears adequately
5 protective, Reclamation would petition the SWRCB to modify New Melones
6 water rights accordingly. The movement of the compliance point is considered in
7 Alternative 3 in this EIS.

8 *In-Basin Requirements: Water Quality in the Lower San Joaquin River*

9 SWRCB D-1422 required Reclamation to operate New Melones to maintain
10 average monthly levels of 500 parts per million (ppm) total dissolved solids
11 (TDS) in the San Joaquin River at Vernalis as it enters the Delta. SWRCB
12 D-1641 modified the water quality objectives at Vernalis to include the irrigation
13 and non-irrigation season objectives contained in the 1995 WQCP: average
14 monthly electric conductivity (EC) of 0.7 milliSiemens per centimeter (mS/cm)
15 during the months of April through August and 1.0 mS/cm during the months of
16 September through March.

17 *1997 New Melones Interim Plan of Operations*

18 In 1997, Reclamation developed the Interim Plan of Operations as a joint effort
19 with USFWS and in conjunction with the Stanislaus River Basin Stakeholders
20 (SRBS). The process of developing the plan began in 1995 with a goal to develop
21 a long-term management plan with clear operating criteria, given a fundamental
22 recognition by all parties that New Melones Reservoir water supplies are over-
23 committed on a long-term basis, and consequently, unable to meet all the potential
24 beneficial uses designated as purposes.

25 In 1996, the focus shifted to the development of an interim operations plan for
26 1997 and 1998. At an SRBS meeting on January 29, 1997, a final interim plan of
27 operation was agreed to in concept. The Interim Plan of Operation (IPO) was
28 transmitted to the SRBS on May 1, 1997. Although meant to be a short-term plan
29 for non-low periods only, it continued to be the guiding operations criteria in
30 effect for the annual planning to meet multiple beneficial uses from New Melones
31 Reservoir storage. The plan limited released water based on the available water
32 supply, known as the New Melones Index, as summarized in Tables 3A.9
33 and 3A.10.

34 **Table 3A.9 Inflow/Storage Characterization for the New Melones IPO**

Annual Water Supply Category	March–September Forecasted Inflow Plus End of February Storage (TAF)
Low	0–1,400
Medium-low	1,400–2,000
Medium	2,000–2,500
Medium-high	2,500–3,000
High	3,000–6,000

1 The IPO suggested available quantities for various categories of water supply
2 based on storage and projected inflow, as summarized in Table 3A.10. The
3 annual water categories are for in-stream fishery enhancement (1987 CDFW
4 Agreement and CVPIA Section 3406(b)(2) management), SWRCB D-1641
5 San Joaquin River water quality requirements (Water Quality), SWRCB D-1641
6 Vernalis flow requirements (Bay-Delta), and use by CVP contractors.

7 **Table 3A.10 New Melones Modified IPO Flow Objectives (in TAF)**

Storage Plus Inflow		Fishery		Vernalis Water Quality		Bay-Delta		CVP Contractors	
From	To	From	To	From	To	From	To	From	To
1,400	2,000	98	125	70	80	0	0	0	0
2,000	2,500	125	345	80	175	0	0	0	59
2,500	3,000	345	467	175	250	75	75	90	90
3,000	6,000	467	467	250	250	75	75	90	90

8 Although SEWD/CSJWCD agreed to this plan for a 2-year period, they
9 subsequently successfully litigated against Reclamation. As a consequence,
10 Reclamation is now required to provide the full contract amount to the CVP
11 contractors except during times of drought. This plan also assumed that the full
12 responsibility of Vernalis objectives would fall to the Stanislaus River and New
13 Melones Reservoir rather than be divided up among the other San Joaquin
14 tributaries.

15 *Water Temperatures*

16 Water temperatures in the lower Stanislaus River are affected by many factors and
17 operational tradeoffs. These include available cold water resources in New
18 Melones reservoir, Goodwin release rates for fishery flow management, ambient
19 air conditions, and residence time in Tulloch Reservoir, as affected by local
20 irrigation demand.

21 *CVPIA 3406 (b)(2) Operations on the Stanislaus River*

22 2009 NMFS BO RPA flows described below are often accounted for dedication
23 of (b)(2) water on the Stanislaus River below Goodwin Dam in addition to the
24 CDFW requirements discussed previously in the East Side Division.

25 *Implementation of 2009 National Marine Fisheries Service Biological Opinion*

26 The 2009 NMFS BO RPA requires Reclamation to adaptively manage flows to
27 meet minimum instream flow, ramping flow, pulse flow, floodplain inundation,
28 and geomorphic and function flow patterns, through the following actions.

- 29 • Minimum base flows to optimize available steelhead habitat for adult
30 migration, spawning, and juvenile rearing by water year type, as measured

1 downstream of Goodwin Dam, as specified in Appendix 2-E of the 2009
2 NMFS BO RPA.

- 3 • Fall pulse flows to improve instream conditions.
- 4 • Winter instability flows to simulate natural variability in the winter
5 hydrograph and to enhance access to varied rearing habitats.
- 6 • Channel forming and maintenance flows in the 3,000 to 5,000 cfs range in
7 above normal and wet years to maintain spawning and rearing habitat quality
8 after March 1 to protect incubating eggs and to provide outmigration flow
9 cues and late spring flows.
- 10 • Outmigration flow cues to enhance likelihood of anadromy.
- 11 • Late spring flows for conveyance and maintenance of downstream migratory
12 habitat quality in the lowest reaches and into the Delta.

13 Flows also are released to meet the following temperature requirements (see 2009
14 NMFS BO RPA for exception criteria) to protect steelhead.

- 15 • October 1 (or initiation of fall pulse flow) through December 31: 56° F at
16 Orange Blossom Bridge
- 17 • January 1 through May 31: 52° F at Knights Ferry and below 55° F at Orange
18 Blossom Bridge
- 19 • June 1 through September 30: 65° F at Orange Blossom Bridge

20 Reclamation also is required to evaluate an approach to operate New Melones
21 Reservoir flow releases to achieve floodplain inundation flows and improved
22 freshwater migratory habitat for steelhead.

23 **3A.4.3.6 San Felipe Division**

24 Construction of the San Felipe Division of the CVP was authorized in 1967. The
25 San Felipe Division initiated operation in 1987 and provides a water supply in the
26 Santa Clara Valley in Santa Clara County and the north portion of San Benito
27 County.

28 The San Felipe Division delivers both irrigation and M&I water supplies. Water
29 is delivered within the service areas not only by direct diversion from distribution
30 systems, but also through instream and offstream groundwater recharge
31 operations conducted by local water users. A primary purpose of the San Felipe
32 Division in Santa Clara County is to provide supplemental water to help prevent
33 land surface subsidence in the Santa Clara Valley. The majority of the water
34 supplied to Santa Clara County is used for M&I purposes, either pumped from the
35 groundwater basin or delivered from treatment plants. In San Benito County, a
36 distribution system was constructed to provide water to about 19,700 arable acres.

37 The San Felipe Division facilities that serve Santa Clara and San Benito Counties
38 include 54 miles of tunnels and conduits, two large pumping plants, and one
39 reservoir (San Justo Reservoir in San Benito County). CVP water is conveyed

1 from the Delta through the DMC, O'Neill Forebay, and San Luis Reservoir. A
2 maximum of 480 cfs is lifted from San Luis Reservoir by the Pacheco Pumping
3 Plant's twelve 2,000-horsepower pumps to a height varying from 85 to 300 feet
4 into a regulating tank. Water flows from the regulating tank by gravity through
5 the 5.2-mile long Pacheco Tunnel and 7.9-mile long Pacheco Conduit. The
6 Pacheco Conduit terminates at a bifurcation structure, where the water is
7 conveyed into Santa Clara and San Benito Counties.

8 In Santa Clara County, water flows from the bifurcation structure into the 1-mile
9 long Santa Clara Tunnel. Water flows by gravity from the tunnel into a 20-mile
10 long Santa Clara Conduit to the Coyote Pumping Plant for distribution of CVP
11 water within Santa Clara County. In San Benito County, water flows from the
12 bifurcation structure to the 19.1-mile long Hollister Conduit with a maximum
13 capacity of approximately 93 cfs, terminating at the San Justo Reservoir.

14 Santa Clara Valley Water District operates the San Felipe Division facilities
15 except for the Hollister Conduit and San Justo Reservoir, which are operated by
16 San Benito County Water District under operating agreements with Reclamation.

17 The 9.906 TAF-capacity San Justo Reservoir is located about 3 miles southwest
18 of the city of Hollister. The San Justo Dam is an earthfill structure 141 feet high
19 with a crest length of 722 feet. This facility includes a dike structure 66 feet high
20 with a crest length of 918 feet. This reservoir regulates San Benito County Water
21 District's CVP water supplies, allows pressure deliveries to some of the
22 agricultural lands in the service area, and provides storage for peaking of
23 agricultural water.

24 **3A.4.3.7 Friant Division**

25 As described previously, Friant Division operations are not analyzed in this EIS.
26 The information included below provides an understanding of how the Friant
27 Division operations affect CVP and SWP operations.

28 Historically, this division was hydrologically disconnected from the rest of the
29 CVP except in very wet years and was not integrated into the CVP Operations
30 Criteria and Plan (OCAP). Friant Dam is located on the San Joaquin River,
31 25 miles northeast of Fresno where the San Joaquin River exits the Sierra Nevada
32 foothills and enters the Central Valley. The drainage basin is 1,676 square miles
33 with an average annual runoff of 1,774 TAF. Completed in 1942, the dam is a
34 concrete gravity structure, 319 feet high, with a crest length of 3,488 feet.
35 Although the dam was completed in 1942, it was not placed into full
36 operation until 1951. The reservoir, Millerton Lake, first stored water on
37 February 21, 1944. It has a total capacity of 524 TAF, a surface area of
38 4,900 acres, and is approximately 15 miles long. The lake's 45 miles of shoreline
39 varies from gentle slopes near the dam to steep canyon walls farther inland. The
40 reservoir provides boating, fishing, picnicking, and swimming.

41 The dam provides flood control on the San Joaquin River, provides downstream
42 releases to meet senior water rights requirements above Mendota Pool, and
43 provides conservation storage as well as diversion into Madera and Friant-Kern

1 Canals. Water is delivered to a million acres of agricultural land in Fresno, Kern,
2 Madera, and Tulare Counties in the San Joaquin Valley via the Friant-Kern Canal
3 south into Tulare Lake Basin and via the Madera Canal northerly to Madera and
4 Chowchilla Irrigation Districts. A minimum of 5 cfs is required to pass the last
5 water right holding located about 40 miles downstream of Friant Dam near
6 Gravelly Ford. Before October 1, 2009, and the initiation of Interim Flows for the
7 San Joaquin River Restoration Program (SJRRP), the Friant Division was
8 generally hydrologically disconnected from the Delta. The San Joaquin River
9 was dewatered in two reaches between Friant Dam and the confluence of the
10 Merced River, except under flood conditions.

11 Flood control storage space in Millerton Lake is based on a complex formula,
12 which considers upstream storage in the Southern California Edison reservoirs,
13 forecasted snowmelt, and time of year. Flood management releases occur
14 approximately every 3 years and are managed based on downstream channel
15 design flow of approximately 8,000 cfs, to the extent possible. Under flood
16 conditions, water is diverted into two bypass channels that carry flood flows to
17 near the confluence of the Merced River. Flows staying in the mainstem are
18 diverted into the Mendota Pool, and may be used to meet irrigation
19 demands there.

20 **3A.4.3.8 San Joaquin River Restoration Program**

21 In 2006, parties to *NRDC, et al., v. Rodgers, et al.*, executed a stipulation of
22 settlement that called for a comprehensive long-term effort to restore flows to the
23 San Joaquin River from Friant Dam to the confluence of the Merced River and a
24 self-sustaining Chinook Salmon fishery while reducing or avoiding adverse water
25 supply impacts. The SJRRP implements the Settlement consistent with the San
26 Joaquin River Restoration Settlement Act in Public Law 111-11. Consultation
27 with NMFS and USFWS under the ESA on implementation of the Settlement has
28 occurred as part of the SJRRP and would continue to occur to evaluate the effects
29 of implementation of settlement actions on listed species. USFWS issued a
30 Programmatic BO (PBO) for the implementation of the SJRRP on
31 August 21, 2012 and NMFS issued a PBO on September 18, 2012. The
32 programmatic Biological Opinions include project-level consultation for SJRRP
33 flow releases of up to 1,660 cfs from Friant Dam down the San Joaquin River.
34 Programmatic ESA coverage is provided in both the USFWS and NMFS PBOs
35 for flow releases from Friant Dam up to 4,500 cfs and all physical restoration and
36 water management actions listed in the Settlement. Future flow increases from
37 Friant Dam in excess of 1,660 cfs for the SJRRP would need to be coordinated
38 and consulted on with the appropriate regulatory agencies to ensure ESA
39 compliance.

40 The Settlement-required flow targets for releases from Friant Dam include
41 six water year types for releases depending upon available water supply as
42 measures of inflow to Millerton Lake. The releases from Friant Dam include the
43 flexibility to reshape and retime releases forwards or backwards by 4 weeks
44 during the spring and fall pulse periods. Flood flows may potentially occur and

1 meet or exceed the Settlement flow targets. If flood flows meet the Settlement
2 flow targets, then Reclamation would not release additional water. The San
3 Joaquin River channel downstream of Friant Dam currently lacks the capacity to
4 convey flows to the Merced River and releases are limited accordingly.
5 Reclamation has initiated planning and environmental compliance activities to
6 improve river channel conveyance and allow for the full release of SJRRP flows.
7 Diversions and infiltration losses reduce the amount of Settlement flows reaching
8 the San Joaquin and Merced River confluence. Flows that reach the Merced
9 confluence are assumed to continue to the Delta.

10 **3A.5 State Water Project**

11 DWR holds contracts with 29 public agencies in Northern, Central, and Southern
12 California for water supplies from the SWP. Water stored in the Lake Oroville
13 facilities, along with excess water available in the Delta, is captured in the Delta
14 and conveyed through several facilities to SWP water contractors.

15 The SWP is operated to provide flood control and water for agricultural, M&I,
16 recreational, and environmental purposes. Water is conserved in Lake Oroville
17 and released to serve three Feather River area water contractors and two water
18 contractors served from the NBA, and 24 SWP contractors in the SWP service
19 areas in the south San Francisco Bay Area, San Joaquin Valley, and Southern
20 California. In addition to pumping water released from Lake Oroville, the Banks
21 Pumping Plant diverts natural inflow available in the Delta.

22 **3A.5.1 Project Management Objectives**

23 The SWP is managed to maximize the capture of usable Delta supplies released
24 from Lake Oroville storage as well as surplus supplies available in the Delta. The
25 maximum daily pumping rate at Banks Pumping Plant is controlled by a
26 combination of SWRCB D-1641, the requirements contained in the BOs, the
27 adaptive management process, and permits issued by USACE that regulate the
28 rate of diversion of water into CCF for pumping at Banks Pumping Plant. This
29 diversion rate is normally restricted to 6,680 cfs as a 3-day average inflow to CCF
30 and 6,993 cfs as a 1-day average inflow to CCF. CCF diversions may be greater
31 than these rates between December 15 and March 15, when the inflow into CCF
32 may be augmented by one-third of the San Joaquin River flow at Vernalis when
33 those flows are equal to or greater than 1,000 cfs. Additionally, the SWP has a
34 permit to export an additional 500 cfs between July 1 and September 30 based
35 upon on Project losses for same water year to protect listed fish.

36 The CCF radial gates are closed during critical periods of the ebb/flood tidal cycle
37 to protect water levels relied upon by local agricultural water diverters in the
38 south Delta area.

39 Banks Pumping Plant is operated to minimize the impact on power loads on the
40 California electrical grid to the extent practical, using CCF as a holding reservoir

1 to allow that flexibility. Generally more pump units are operated during off-peak
2 periods and fewer during peak periods. Because the installed capacity of the
3 pumping plant is 10,300 cfs, the plant can be operated to reduce power grid
4 impacts by running all available pumps at night and fewer during the higher
5 energy-demand hours, even when CCF is diverting the maximum daily
6 permitted rate.

7 There are some water years (primarily wetter years) when excess conditions exist
8 for a sufficient portion of the year such that enough water can be diverted from
9 the Delta to fill the SWP south of Delta reservoirs and meet all SWP Contractor
10 demands without maximizing Banks Pumping Plant pumping capability every day
11 of the year. However, CCF operations are more often supply limited. Under
12 these conditions, CCF is typically operated to maximize the water captured,
13 subject to the limitations of water quality, Delta standards, and a host of other
14 variables, to meet SWP demands and fill storage south of the Delta.

15 San Luis Reservoir is an offstream storage facility located along the California
16 Aqueduct downstream of Banks Pumping Plant. San Luis Reservoir is used by
17 both Projects to augment deliveries to their contractors and water contractors
18 during periods when Delta pumping is insufficient to meet downstream demands.

19 DWR stores water in San Luis Reservoir when Banks Pumping Plant pumping
20 exceeds SWP Contractor demands, and releases water to the California Aqueduct
21 system when Banks Pumping Plant pumping is insufficient to meet demands. The
22 reservoir allows the SWP to meet peak-season demands that supplies available at
23 Banks Pumping Plant.

24 San Luis Reservoir is generally filled in the spring or even earlier in some years.
25 When all SWP demands are met, including diversion to storage facilities south of
26 the Delta, and Table A demands, and the Delta is in excess conditions, DWR
27 would use available excess pumping capacity at Banks Pumping Plant to make
28 excess water supplies, called Article 21 water under the long-term SWP water
29 supply contracts, available to the SWP Contractors.

30 Article 21 describes the conditions under which water can be delivered in addition
31 to the amounts specified in Table A of the contracts.

32 Article 21 provides, in part: “Each year from water sources available to the
33 project, the State shall make available and allocate interruptible water to
34 contactors. Allocations of interruptible water in any one year may not be carried
35 over for delivery in a subsequent year, nor shall the delivery of water in any year
36 impact a contractor’s approved deliveries of annual [Table A water] or the
37 contractor’s allocation of water for the next year. Deliveries of interruptible water
38 in excess of a contractor’s annual [Table A water] may be made if the deliveries
39 do not adversely affect the State’s delivery of annual [Table A water] to other
40 contractors or adversely affect project operations...”

41 Unlike Table A water, which is an allocated annual SWP supply made available
42 for scheduled delivery throughout the year, Article 21 water is an interruptible
43 water supply made available only when certain conditions exist. However, while

1 not a dependable supply, Article 21 water is an important part of the total SWP
2 supplies provided to the SWP contractors. As with all SWP water, Article 21
3 water is pumped consistent with the existing terms and conditions of SWP water
4 rights permits, and is pumped from the Delta under the same environmental,
5 regulatory, and operational constraints that apply to all SWP operations.

6 When Article 21 water is only available as long as the required conditions exist as
7 determined by DWR. Since Article 21 deliveries are in addition to scheduled
8 Table A deliveries, this supply is delivered to SWP contractors that can, on
9 relatively short notice, put it to beneficial use. SWP contractors have used
10 Article 21 water to meet needs such as additional short-term irrigation demands,
11 replenishment of local groundwater basins, short-term substitution of local
12 supplies and storage in local surface reservoirs for later use by the requesting
13 SWP contractor, all of which provide SWP contractors with opportunities for
14 better water management through more efficient coordination with their local
15 water supplies. Allocated Article 21 water to a SWP contractor cannot be
16 transferred.

17 Article 21 water is typically offered to SWP contractors on a short-term (daily or
18 weekly) basis when all of the following conditions exist: the SWP share of San
19 Luis Reservoir is physically full, or projected to be physically full; other SWP
20 reservoirs south of the Delta are at their storage targets or the SWP conveyance
21 capacity to fill these reservoirs is maximized; the Delta is in excess condition;
22 current Table A and SWP operational demands are being fully met; and Banks
23 Pumping Plant has export capacity beyond that which is needed to meet all
24 Table A and other SWP operational demands. The increment of available unused
25 Banks Pumping Plant capacity is offered as the Article 21 delivery capacity.
26 SWP contractors then indicate their desired rate of delivery of Article 21 water.
27 DWR allocates the available Article 21 water in proportion to the requesting SWP
28 contractors annual Table A amounts if requests exceed the amount offered.
29 Deliveries can be discontinued at any time when SWP operations change. In the
30 modeling for Article 21, deliveries are only made in months when the SWP share
31 of San Luis Reservoir is full. In actual operations, Article 21 may be offered a
32 short period in advance of actual filling.

33 By April or May, demands from both agricultural and M&I SWP Contractors
34 usually exceed the pumping rate at Banks, and releases from San Luis Reservoir
35 to the SWP facilities are needed to supplement the Delta pumping at Banks
36 Pumping Plant to meet SWP contractor demands for Table A water

37 During the summer period, DWR is also releasing water from Lake Oroville to
38 supplement Delta inflow and allow Banks Pumping Plant to export the stored
39 Lake Oroville water to help meet demand. These releases are scheduled to
40 maximize export capability and gain maximum benefit from the stored water
41 while meeting fish flow requirements, temperature requirements, Delta water
42 quality, and all other applicable standards in the Feather River and the Delta.

1 DWR must balance storage between Lake Oroville and San Luis Reservoirs
2 carefully to meet flood control requirements, Delta water quality and flow
3 requirements, and optimize the supplies to its SWP water contractors consistent
4 with all environmental constraints. Lake Oroville may be operated to move water
5 through the Delta to San Luis Reservoir via Banks Pumping Plant under different
6 schedules depending on Delta conditions, reservoir storage volumes, and storage
7 targets. Predicting those operational differences is difficult, as the decisions
8 reflect operator judgment based on many real-time factors as to when to move
9 water from Lake Oroville to San Luis Reservoir.

10 The SWP share of San Luis Reservoir is drawn down to meet SWP contractor
11 demands and usually reaches its low point in late August or early September.
12 From September through early October, demand for deliveries usually drops
13 below the capacity of Banks Pumping Plant to divert from the Delta, and DWR
14 can begin diverting water to San Luis Reservoir to begin refilling the reservoir.
15 Unregulated flow reaching the Delta typically continues to decline throughout the
16 fall until the first major storms occur, typically last fall or winter. Once the fall
17 and winter storms increase runoff into the Delta, Banks Pumping Plant can
18 increase its pumping rate and, in all but the driest years, eventually fill the state
19 portion of San Luis Reservoir before April of the following year.

20 **3A.5.2 Water Service Contracts, Allocations, and Deliveries**

21 The following discussion presents DWR's practices for determining the overall
22 amount of Table A water that can be allocated annually and the allocation process
23 itself. Many variables control how much water the SWP can capture and provide
24 to its SWP water contractors for beneficial use.

25 The allocations are developed from analysis of a broad range of variables that
26 include the following.

- 27 • Volume of water stored in Lake Oroville.
- 28 • Flood operation restrictions at Lake Oroville.
- 29 • Volume of water stored in Lake Oroville.
- 30 • End-of- year target for water stored in Lake Oroville.
- 31 • Volume of water stored in San Luis Reservoir.
- 32 • End-of-month targets for water stored in San Luis Reservoir.
- 33 • Snow survey results.
- 34 • Forecasted runoff.
- 35 • Feather River flow requirements for fish habitat.
- 36 • Feather River service area delivery obligations.
- 37 • Anticipated Feather River downstream of Lake Oroville.
- 38 • Anticipated depletions in the Sacramento River basin.

- 1 • Anticipated Delta flow and water quality requirements.
- 2 • Precipitation and streamflow conditions since the last snow surveys and
- 3 forecasts.
- 4 • SWP water contract delivery requests and delivery patterns.

5 From these and other variables, DWR staff estimates the SWP water supply
6 available to meet Table A water deliveries SWP contractors and other SWP
7 needs. The initial allocation announcement by the Director of DWR is made by
8 December 1 of each year. The allocation of water is made with a conservative
9 assumption of future precipitation, and generally in graduated steps, carefully
10 avoiding over-allocating water before the hydrologic conditions are well defined
11 for the year. The allocation of the available SWP supply to the SWP contractors
12 is based on the SWP contractors' initial requests for Table A water. As the year
13 proceeds and more information is available on the hydrologic conditions, the
14 SWP contractors may revise their initial Table A water requests considering their
15 actual local supplies.

16 Other influences affect the accuracy of estimates of annual demand for Table A
17 water and the resulting allocation percentage. One factor is the contractual ability
18 of SWP contractors to carry over allocated but undelivered Table A from one year
19 to the next if capacity is available in San Luis Reservoir. SWP contractors would
20 generally use their carryover supplies early in the calendar year if it appears that
21 the capacity would be needed for SWP operations. Carryover supplies left in San
22 Luis Reservoir by SWP contractors may result in higher storage levels in San Luis
23 Reservoir at December 31 than would have occurred in the absence of carryover.
24 The carryover program, when available, provides an opportunity for the SWP
25 contractors to temporarily store allocated Table A water outside their service area.
26 As Project pumping for SWP operations fills the SWP share of San Luis
27 Reservoir, the SWP contractors are notified to take or lose their carryover
28 supplies. If the SWP contractors are unable to take delivery of any of their
29 carryover water, the carryover water converts to Project water as San Luis
30 Reservoir fills. Article 21 water may become available for delivery to SWP
31 Contractors if the demand for SWP operations are met.

32 The total water exported from the Delta and delivered by the SWP in any year is a
33 function of a number of variables beyond those listed above that help determine
34 Table A allocations.

35 The total amount of Article 21 water delivered does not provide a measure of the
36 change in Delta diversions attributable to Article 21 deliveries. Instead, one must
37 analyze the total exports from the Delta.

38 **3A.5.2.1 Monterey Agreement**

39 In 1994, DWR and certain representatives of the SWP water contractors
40 negotiated a set of principles designed to modify the long-term SWP water supply
41 contracts. This set of principles, which came to be known as the Monterey
42 Agreement, helped to settle long-term water allocation disputes and to establish

1 new water management strategies for the SWP. An Environmental Impact Report
2 (EIR) was prepared on the Monterey Agreement and certified in 1995. Following
3 certification of the EIR, 27 of the 29 SWP water contractors incorporated most of
4 the principles into a contract amendment which is known as the Monterey
5 Amendment. The Monterey Amendment was implemented in 1996. The 1995
6 EIR was subject to judicial challenge. In 2000, the EIR was found to be
7 inadequate. DWR, the SWP water contractors, and the plaintiffs entered into a
8 Settlement Agreement in 2003. As a result of the Settlement Agreement, the
9 Court issued an order in June 2003 that the EIR be decertified and that DWR
10 prepare a new EIR. The order also required DWR to continue to operate the SWP
11 in accordance with the Monterey Amendment as it had done since 1996 and in
12 accordance with the Settlement Agreement. A draft of the new EIR was released
13 in October 2007. After incorporating over 600 comments, the final EIR was filed
14 with the State Clearinghouse on May 5, 2010. After considering the final EIR and
15 the alternatives, DWR approved the proposed project of continuing to operate
16 under the existing Monterey Amendment and Settlement Agreement. The EIR,
17 and the validity of the Monterey Amendment, was challenged in June 2010 and
18 the issues raised in the complaints are currently being litigated.

19 **3A.5.3 Project Facilities**

20 **3A.5.3.1 Oroville Field Division**

21 Oroville Dam and related facilities comprise a multipurpose project. The
22 reservoir stores winter and spring runoff, which is released into the Feather River
23 to meet the Project's needs, Delta water quality, and fish and wildlife protection.
24 It also provides p electrical generation, including pumpback operations, 750 TAF
25 of flood control storage, and recreation opportunities.

26 The Oroville Project facilities include two small embankments, Bidwell Canyon
27 and Parish Camp Saddle Dams and Oroville Dam which forms Lake Oroville.
28 The lake has a surface area of 15,810 acres, a storage capacity of 3,538 TAF, and
29 is fed by the North, Middle, and South forks of the Feather River. Average
30 annual unimpaired runoff into the lake is about 4.5 MAF.

31 A maximum of 17,400 cfs can be released through the Edward Hyatt Power Plant,
32 located underground near the left abutment of Oroville Dam. Three of the six
33 units are conventional generators driven by vertical-shaft, Francis-type turbines.
34 The other three are motor-generators coupled to Francis-type, reversible pump
35 turbines. The latter units allow pumped storage operations. The intake structure
36 has an overflow type shutter system that determines the level from which water is
37 drawn.

38 Approximately 4 miles downstream of Oroville Dam and Edward Hyatt Power
39 Plant is the Thermalito Diversion Dam. Thermalito Diversion Dam consists of a
40 625-foot-long, concrete gravity section with a regulated ogee spillway that
41 releases water to the low flow channel of the Feather River. On the right
42 abutment is the Thermalito Power Canal regulating headwork structure.

1 The purpose of the diversion dam is to divert water into the 2-mile long
2 Thermalito Power Canal that conveys water in either direction and creates a
3 tailwater pool (Thermalito Diversion Pool) for Edward Hyatt Power Plant. The
4 Thermalito Diversion Pool acts as a forebay when Hyatt is pumping water back
5 into Lake Oroville. On the left abutment is the Thermalito Diversion Dam Power
6 Plant, with a capacity of 615 cfs that releases water to the low-flow section of the
7 Feather River.

8 Thermalito Power Canal hydraulically links the Thermalito Diversion Pool to the
9 Thermalito Forebay (11.768 TAF), which is the off-stream regulating reservoir
10 for Thermalito Power Plant.

11 Thermalito Power Plant is a generating-pumping plant operated in tandem with
12 the Edward Hyatt Power Plant. Water released to generate power in excess of
13 local and downstream requirements is conserved in storage and, at times, pumped
14 back through both power plants into Lake Oroville during off-peak hours. Energy
15 price and availability are the two main factors that determine if a pumpback
16 operation is economical. Pumpback operation typically occur during off-peak
17 hours when energy prices are lower. The Oroville Thermalito Complex has a
18 capacity of approximately 17,000 cfs through the power plants. Water is returned
19 to the Feather River via the Thermalito Afterbay river outlet.

20 Five agricultural districts divert water directly from the Thermalito Afterbay
21 under the terms of water right settlement agreement with DWR. The diversion
22 facilities replace the historic river diversion used by the local districts prior to the
23 construction of the Thermalito Complex. The total capacity of afterbay diversions
24 during peak demands is 4,050 cfs.

25 The Feather River Fish Hatchery (FRFH), mitigation for the construction of
26 Oroville Dam, rears Chinook Salmon and steelhead and is operated by CDFW.
27 The NMFS FERC BO is being developed at this time, and is considered to be
28 implemented under all of the alternatives and the Second Basis of Comparison in
29 this EIS. Both indirect and direct take resulting from FRFH operations will be
30 authorized through Section 4(d) of the Endangered Species Act, in the form of
31 NMFS-approved Hatchery and Genetic Management Plans (HGMPs). DWR and
32 CDFW are jointly preparing HGMPs for the spring and fall-run Chinook Salmon
33 and steelhead production programs at the Feather River Fish Hatchery.

34 **3A.5.3.1.1 Current Operations—Minimum Flows and Temperature** 35 **Requirements**

36 Operation of Lake Oroville would continue under existing criteria until DWR
37 receives the new FERC license. The temperature of the water released from
38 Oroville Dam is designed to meet the temperature requirements for the FRFH,
39 under the August 1983 CDFW Agreement titled Concerning the Operation of the
40 Oroville Division of the State Water Project for Management of Fish and
41 Wildlife, and for Robinson Riffle while also conserving the coldwater pool in
42 Lake Oroville. Current operation indicates that water temperatures at Robinson
43 Riffle are almost always met when the hatchery objectives are met.

1 Water is withdrawn from Lake Oroville at depths that provide sufficiently cold
2 water to meet the FRFH and Robinson Riffle temperature targets. The reservoir
3 depth from which water is released initially determines the river temperatures, but
4 atmospheric conditions, which fluctuate from day to day, influence downstream
5 river temperatures. Altering the reservoir release depth requires installation or
6 removal of shutters at the intake structures. Shutters are held at the minimum
7 depth necessary to release water that meets the FRFH and Robinson Riffle
8 criteria. In order to conserve the coldwater pool during dry years, DWR strives to
9 meet the Robinson Riffle temperatures by increasing releases to the low flow
10 channel (LFC) rather than releasing colder water.

11 Additionally, DWR maintains a minimum flow of 600 cfs within the Feather
12 River LFC as required by the 1983 CDFW Agreement (except during flood events
13 when flows are governed by USACE's Water Control Manual and under certain
14 other conditions as described in the 1984 FERC order). Downstream of the
15 Thermalito Afterbay Outlet, in the high flow channel (HFC), per the license and
16 the 1983 CDFW Agreement, minimum releases for flows in the Feather River are
17 1,000 cfs from April through September and 1,700 cfs from October through
18 March, when the April-to-July unimpaired runoff in the Feather River is greater
19 than 55 percent of normal. When the April-to-July unimpaired runoff is less than
20 55 percent of normal, the minimum flow requirements are 1,000 cfs from March
21 to September and 1,200 cfs from October to February (Table 3A.11). The 1983
22 CDFW Agreement also states that if the April 1 runoff forecast in a given year
23 indicates that the reservoir level would be drawn down to 733 feet, water releases
24 for fish may be reduced, but not by more than 25 percent.

25 In addition, according to the 1983 Agreement, during the period of October 15 to
26 November 30, if the average highest 1-hour flow of combined releases exceeds
27 2,500 cfs, then the minimum flow must be no lower than 500 cfs less than that
28 flow through the following March 31 (with the exception of flood management,
29 accidents, or maintenance.) In practice, flows are maintained below 2,500 cfs
30 from October 15 to November 30 to prevent spawning in the overbank areas.

1 **Table 3A.11 Combined Minimum Instream Flow Requirements in the Feather River**
 2 **below Thermalito Afterbay Outlet When Lake Oroville Elevation is Projected to be**
 3 **Greater vs. Less than 733 Feet in the Current Water Year**

Conditions	Period	Minimum Flows (cfs)
When Lake Oroville Elevation is Projected to be Greater Than 733 feet and the Preceding Water Year's April–July Water Conditions are > 55 percent of Normal ^a	October–February	1,700
	March	1,700
	April–September	1,000
When Lake Oroville Elevation is Projected to be Greater Than 733 feet and the Preceding Water Year's April–July Water Conditions are < 55 percent of Normal ^a	October–February	1,200
	March	1,000
	April–September	1,000
When Lake Oroville Elevation is Projected to be Less Than 733 feet in the Current Water Year ^b	October–February	900 < flow < 1,200
	March	750 < flow < 1,000
	April–September	750 < flow < 1,000

4 Notes:

5 a. Normal is defined as the Mean April–July Unimpaired Runoff of the Feather River near
 6 Oroville of 1,942 TAF (1911–1960).

7 b. In accordance with FERC's Order Amending License dated September 18, 1984,
 8 Article 53 was amended to provide a third tier of minimum flow requirements defined as
 9 follows: If the April 1 runoff forecast in a given water year indicates that, under normal
 10 operation of Project 2100, the reservoir level would be drawn to elevation 733 feet
 11 (approximately 1,500 TAF), releases for fish life in the above schedule may suffer
 12 monthly deficiencies in the same proportion as the respective monthly deficiencies
 13 imposed upon deliveries of water for agricultural use from the Project. However, in no
 14 case shall the fish water releases in the above schedule be reduced by more than
 15 25 percent.

16 Current operations of the Oroville Facilities are governed by water temperature
 17 requirements at two locations: the FRFH and in the LFC at Robinson Riffle.
 18 DWR has taken various temperature management actions to achieve the water
 19 temperature requirements, including curtailing pumpback operations, removing
 20 shutters at the intakes of the Hyatt Pumping-Generating Plant, releasing flow
 21 through the river valves (for FRFH only), and redirecting flows at the Thermalito
 22 Diversion Dam to the LFC (for Robinson Riffle only).

23 To date, the river valves have been used infrequently. Prior to 1992, they were
 24 used twice: first in 1967 during the initial construction of the dam, and second in
 25 1977 during the drought of record. Since 1992, the river valves have only been

1 used for temperature control: in 2001, 2002, and 2008. DWR plans to manage its
2 cold water storage and its intake shutters in order to meet its temperature
3 obligations. Other than local diversions, outflow from the Oroville Project is to
4 the Feather River at the LFC and Thermalito Afterbay. Combined outflow
5 typically varies from spring seasonal highs averaging 8,000 cfs to between
6 1,200 cfs and 2,400 cfs in the fall. The average annual outflow from the Project is
7 in excess of 3 MAF to support downstream water supply, environmental, and
8 water quality needs.

9 Table 3A.12 shows an example of releases from Oroville Project Facilities for
10 various downstream uses during dry hydrologic conditions (Water Years [WYs]
11 2008 and 2009). As a practical matter, water supply is released for exports only
12 after all other Project obligations are met, including Delta requirements and
13 deliveries to local settlement contractors. A portion of the water released for
14 minimum instream requirements and may be exported in the Delta for other water
15 supply purposes.

16 **Table 3A.12 Historical Records of Releases from the Oroville Facilities in 2008 and**
17 **2009, by Downstream Use**

Downstream Use	Water Year 2008 Release		Water Year 2009 Release	
	Volume (TAF)	Percentage	Volume (TAF)	Percentage
Feather River Service Area	1,039	47	1,077	40
Instream and Delta Requirements	1,043	47	1,140	42
Flood Management	0	0	0	0
Support of Exports	130	6	506	19
Total	2,212	100	2,723	100

18 Source: DWR SWP Operations Control Office.

19 **3A.5.3.1.2 Low Flow Channel**

20 The 1983 Agreement specifies that DWR release a minimum of 600 cfs into the
21 Feather River from the Thermalito Diversion Dam for fishery purposes. This is
22 the total volume of flows from the diversion dam outlet, diversion dam power
23 plant, and FRFH pipeline.

24 **3A.5.3.1.3 High Flow Channel**

25 Based on the 1983 Agreement, Table 3A.13 summarizes the minimum flow
26 requirement for the HFC when releases would not draw Lake Oroville below
27 elevation 733 feet above mean sea level (ft msl).

1 **Table 3A.13 High Flow Channel Minimum Flow Requirements as Measured**
2 **Downstream from the Thermalito Afterbay Outlet**

Forecasted April- through-July Unimpaired Runoff (Percent of Normal*)	Minimum Flow in HFC (cfs) October through February	Minimum Flow in HFC (cfs) March	Minimum Flow in HFC (cfs) April through September
55 percent or greater	1,700	1,700	1,000
Less than 55 percent	1,200	1,000	1,000

3 Source: 1983 Agreement.

4 Notes:

5 * The preceding water year's unimpaired runoff shall be reported in Licensee's Bulletin
6 120, Water Conditions in California-Fall Report. The term "normal" is defined as the April-
7 through-July mean unimpaired runoff near Oroville of 1,942 TAF in the period of 1911
8 through 1960.

9 HFC = High Flow Channel.

10 If the April 1 forecast in a given water year indicates that Lake Oroville would be
11 drawn down to elevation 733 feet mean sea level, minimum flows in the HFC
12 may be diminished on a monthly average basis, in the same proportion as the
13 respective monthly deficiencies imposed on deliveries for agricultural use of the
14 Project. However, in no case shall the minimum flow releases be reduced by
15 more than 25 percent. If between October 15 and November 30, the highest total
16 1-hour flow exceeds 2,500 cfs, DWR shall maintain a minimum flow within
17 500 cfs of that peak flow, unless such flows are caused by flood flows, or an
18 inadvertent equipment failure or malfunction.

19 **3A.5.3.2 Temperature Requirements**

20 **3A.5.3.2.1 Low Flow Channel**

21 NMFS has established a water temperature requirement for steelhead trout and
22 spring-run Chinook Salmon at Feather River RM 61.6 (Robinson Riffle in the
23 LFC) from June 1 through September 30. The water temperature should be
24 maintained at less than or equal to 65°F on a daily average basis.

25 **3A.5.3.2.2 High Flow Channel**

26 While no numeric temperature requirement currently exists for the HFC, the
27 1983 Agreement requires DWR to provide suitable Feather River water
28 temperatures for fall-run salmon not later than September 15, and to provide for
29 suitable water temperatures below the Thermalito Afterbay Outlet for shad,
30 striped bass, and other warm water fish between May 1 and September 15.

31 Current FRFH intake water temperature, as required by the 1983 CDFW and
32 DWR Agreement and the FERC license are in Table 3A.14.

1 **Table 3A.14 Feather River Fish Hatchery Temperature Requirements**

Period	Temperature (°F) (±4°F Allowed)
April 1 – November 30	
April 1–May 15	51
May 16–May 31	55
June 1–June 15	56
June 16–August 15	60
August 16–August 31	58
September 1–September 30	52
October 1–November 30	51
December 1–March 31	No greater than 55

2 **3A.5.3.3 Flood Control**

3 Flood control operations at Oroville Dam are conducted in coordination with
4 DWR’s Flood Operations Center and in accordance with the requirements set
5 forth by USACE. The Federal Government shared the expense of Oroville Dam,
6 which provides up to 750 TAF of flood control space. The spillway is located on
7 the right abutment of the dam and has two separate elements: a controlled gated
8 outlet and an emergency uncontrolled spillway. The gated control structure
9 releases water to a concrete-lined chute that extends to the river. The
10 uncontrolled emergency spill flows over natural terrain.

11 **3A.5.3.4 Feather River Ramping Rate Requirements**

12 Maximum allowable ramp-down release requirements are intended to prevent
13 rapid reductions in water levels that could potentially cause redd dewatering and
14 stranding of juvenile salmonids and other aquatic organisms. Ramp-down release
15 requirements to the LFC during periods outside of flood management operations,
16 and to the extent controllable during flood management operations, are shown in
17 Table 3A.15.

18 **Table 3A.15 Lower Feather River Ramping Rates**

Releases to the Feather River Low Flow Channel (cfs)	Rate of Decrease (cfs)
5,000 to 3,501	1,000 per 24 hours
3,500 to 2,501	500 per 24 hours
2,500 to 600	300 per 24 hours

19 Source: National Marine Fisheries Service 2004.

1 **3A.5.3.4.1 Federal Energy Regulatory Commission Relicensing of the**
2 **Oroville Project**

3 Until FERC issues the new license for the Oroville Project, DWR will not
4 significantly change the operations of the facilities. When the FERC license is
5 issued, it is assumed that the future flows will remain the same downstream of
6 Thermalito Afterbay Outlet.

7 The original FERC license to operate the Oroville Project expired in January
8 2007. Since then, annual licenses have been issued, with DWR operating to the
9 existing FERC license. FERC continues to issue an annual license until it is
10 prepared to issue the new 50-year license. To prepare for the expiration of the
11 FERC license, DWR began working on the relicensing process in 2001. As part
12 of the process, DWR entered into an SA, signed in 2006, with state, federal, and
13 local agencies, SWP water contractors, non-governmental organizations, Tribal
14 governments, and others to implement improvements within the FERC boundary.
15 The FERC boundary includes all of the Oroville Project facilities, extends
16 upstream into the tributaries of Lake Oroville, includes portions of the LFC on the
17 lower Feather River and downstream of the Thermalito Afterbay Outlet into the
18 HFC. In addition to the SA, a Habitat Expansion Agreement was negotiated to
19 address the fish passage issue over Oroville Dam and NMFS and USFWS's
20 Section 18 Authority under the Federal Power Act.

21 FERC prepared a Final EIS for the Oroville FERC re-licensing and completed it
22 in 2007. A Final EIR was prepared by DWR and completed in 2008. A draft BO
23 was prepared by NMFS in 2009 but is not yet final. SWRCB issued the Clean
24 Water Act Section 401 Certification (401 Certification) for the project in 2010.
25 The new FERC license has not been adopted, but is anticipated to include the
26 FERC license terms and conditions, the 401 Certification, and the terms and
27 conditions therein; DWR will also comply with the requirements in the
28 NMFS BO.

29 The new FERC license may include most if not all of the commitments from the
30 SA. The SA does not change the flows in the HFC although there would be a
31 proposed increase in minimum flows in the LFC. The SA includes habitat
32 restoration actions such as side-channel construction, structural habitat
33 improvement such as boulders and large woody debris, spawning gravel
34 augmentation, a fish counting weir, riparian vegetation and floodplain restoration,
35 and facility modifications to improve coldwater temperatures in the low and high
36 flow channels. The SA, EIR, and the FERC Biological Assessment provide
37 substantial detail on the SA restoration actions in the Lower Feather River.

38 **3A.5.3.4.2 Minimum Flows in the Low Flow and High Flow Channels**

39 The SA requires a minimum flow of 700 cfs to be released into the LFC. The
40 minimum flow is 800 cfs from September 9 to March 31 of each year to
41 accommodate spawning of anadromous fish, unless the NMFS, USFWS, CDFW,
42 and SWRCB provide a written notice that a lower flow (between 700 cfs and
43 800 cfs) substantially meets the needs of anadromous fish. If DWR receives such

1 a notice, it may operate consistent with the revised minimum flow. HFC flows
2 would remain the same as the existing license, consistent with the 1983 DWR and
3 CDFW Operating Agreement to continue to protect Chinook Salmon from redd
4 dewatering (A108.2 of the SA [Appendix C]).

5 **3A.5.3.4.3 Water Temperatures for the Feather River Fish Hatchery**

6 When the FERC license is issued, DWR would use the temperatures in
7 Table 3A.16 as targets, and would seek to achieve them through the use of
8 operational measures described below.

9 **Table 3A.16 Maximum Mean Daily Temperatures**

Period	Maximum Mean Daily Temperature (°F)
September 1–September 30	56
October 1–May 31	55
June 1–August 31	60

10 The maximum mean daily temperatures are calculated by adding the hourly
11 temperatures achieved each day and dividing by 24. DWR would strive to meet
12 maximum mean daily temperatures through operational changes including but not
13 limited to (1) curtailing pump-back operation; (2) removing shutters on Hyatt
14 intake; and (3) altering river valve refurbishment. DWR would consider the use
15 of the river valve up to a maximum of 1500 cfs; however these flows need not
16 exceed the actual flows in the HFC, and should not be less than those specified in
17 HFC minimum flows described above, which would not change with the new
18 FERC license. During this interim period, DWR would not be in violation if the
19 maximum mean daily temperatures are not achieved through operational changes.

20 Prior to FERC license implementation, DWR agreed to begin the necessary
21 studies for the refurbishment or replacement of the river valve. On October 31,
22 2006, DWR submitted to specific agencies a Reconnaissance Study of Facilities
23 Modification to address temperature habitat needs for anadromous fisheries in the
24 LFC and the HFC. Under the provisions of SA Appendix B Section B108(a),
25 DWR has begun a study to evaluate whether to refurbish or replace the river valve
26 that may at times be used to provide cold water for the FRFH.

27 Upon completion of facilities modification(s) as provided in A108, and no later
28 than the end of year ten following license issuance, the temperatures would
29 become requirements, and DWR would not exceed the maximum mean daily
30 temperatures for the remainder of the License term, except in Conference Years
31 as referenced in A107.2(d).

32 During the term of the FERC license, DWR would not exceed the hatchery water
33 temperatures in Table 3A.17. There would be no minimum temperature
34 requirement except for the period of April 1 through May 31, during which the
35 temperatures would not fall below 51°F.

1 **Table 3A.17 Hatchery Water Temperatures**

Period	Maximum Hatchery Water Temperature (°F)
September 1–September 30	56
October 1–November 30	55
December 1–March 31	55
April 1–May 15	55
May 16–May 31	59
June 1–June 15	60
June 16–August 15	64
August 16–August 31	62

2 Upon completion of facilities modification(s) as provided in A108 (discussed
3 below), DWR may develop a new table for hatchery temperature requirements
4 that is at least as protective as Table 3A.17. If a new table is developed, it would
5 be developed in consultation with the Ecological Committee, including
6 specifically USFWS, NMFS, CDFW, SWRCB, and RWQCBs. The new table
7 would be submitted to FERC for approval, and upon approval shall become the
8 temperature requirements for the hatchery for the remainder of the license term.
9 During Conference Years, as defined in A108.6, DWR would confer with
10 USFWS, NMFS, CDFW, and SWRCB to determine proper temperature and
11 hatchery disease management goals.

12 **3A.5.3.4.4 Water Temperatures in the Lower Feather River**

13 Under the SA, DWR is committing to a Feasibility Study and Implementation
14 Plan to improve temperature conditions (facilities modification[s]) for spawning,
15 egg incubation, rearing and holding habitat for anadromous fish in the LFC and
16 HFC (A108.4). The Plan would recommend a specific alternative for
17 implementation and would be prepared in consultation with the resource agencies.

18 Prior to the facilities modification(s) described in Article A108.4, if DWR does
19 not achieve the applicable Robinson Riffle temperature (specified in Table 2-22
20 of the FERC license agreement) upon release of the specified minimum flow,
21 DWR would singly, or in combination with other parties, perform the following
22 actions:

- 23 • Curtail pump-back operation.
- 24 • Remove shutters on Hyatt Intake.
- 25 • Increase flow releases in the LFC up to a maximum of 1500 cfs, consistent
26 with the minimum flow standards in the HFC and temperature targets
27 specified in Table 2-22 of the FERC license agreement; and if the
28 temperatures are not met there is no license violation.

1 If in any given year DWR anticipates that these measures would not achieve the
2 temperatures in Table 3A.18, Low Flow Channel as Measured at Robinson Riffle,
3 DWR would consult with the NMFS, USFWS, CDFW, and SWRCB to discuss
4 potential approaches to best managing the remaining coldwater pool in Lake
5 Oroville, which may result in changes in the way Licensee performs actions (1),
6 (2), and (3) listed above.

7 **Table 3A.18 Low Flow Channel as Measured at Robinson Riffle**

Month	Daily Mean Value Temperature (°F)
January	56°F
February	56°F
March	56°F
April	56°F
May 1–15	56–63°F*
May 16–31	63°F
June 1–15	63°F
June 16–30	63°F
July	63°F
August	63°F
September 1–8	63–58°F*
September 9–30	58°F
October	56°F
November	56°F
December	56°F

8 Note:

9 * Indicates a period of transition from the first temperature to the second temperature.

10 After completing the facilities modification(s), DWR would no longer be required
11 to perform the measures listed in (1), (2), and (3), unless temperatures in
12 Table 3A.17, Hatchery Water Temperatures, are exceeded. DWR would operate
13 the Project to meet temperature requirements, unless it is a Conference Year. The
14 proposed water temperature objectives, measured at the southern FERC project
15 boundary, would be evaluated for potential water temperature improvements in
16 the HFC. DWR would study options for facilities modification(s) to achieve
17 those temperature benefits.

18 There would be a testing period of at least 5 years to determine whether the HFC
19 temperature benefits are being realized. At the end of the testing period, DWR
20 would prepare a testing report that may recommend changes in the facilities,
21 compliance requirements for the HFC and the definition of Conference Years
22 (those years where DWR may have difficulties in achieving the temperature
23 requirements due to hydrologic conditions.) The challenges of implementing

1 temperatures objectives would require the phased development of water
2 temperature objectives and likely, a revision to the objectives prior to values in
3 Table 3A.19, High Flow Channel as Measured at Downstream Project Boundary,
4 becoming a compliance obligation.

5 **Table 3A.19 High Flow Channel as measured at Downstream Project Boundary**

Month	Daily Mean Value Temperature (°F)
January	56
February	56
March	56
April	61
May	64
June	64
July	64
August	64
September	61
October	60
November	56
December	56

6 **3A.5.3.4.5 Habitat Expansion Agreement**

7 The Habitat Expansion Agreement is a component of the 2006 SA to address
8 DWR obligations in regard to blockage and fish passage issues related to the
9 construction of Oroville Dam. Because it deals with offsite mitigation, it will not
10 be included in the new FERC license.

11 Construction of the Oroville Facilities and PG&E's construction of other
12 hydroelectric facilities on the upper Feather River tributaries blocked passage and
13 reduced available habitat for ESA listed anadromous salmonids Central Valley
14 spring-run Chinook Salmon and steelhead. The reduction in spring-run habitat
15 resulted in spatial overlap with fall-run Chinook Salmon and has led to increased
16 redd superimposition, competition for limited habitat, and genetic introgression.
17 FERC relicensing of hydroelectric projects in the Feather River basin has focused
18 attention on the desirability of expanding spawning, rearing and adult holding
19 habitat available for Central Valley spring-run Chinook Salmon and steelhead.
20 The SA Appendix F includes a provision to establish a habitat enhancement
21 program with an approach for identifying, evaluating, selecting and implementing
22 the most promising action(s) to expand such spawning, rearing and adult holding
23 habitat in the Sacramento River Basin as a contribution to the conservation and
24 recovery of these species. The specific goal of the Habitat Expansion Agreement
25 is to expand habitat sufficiently to accommodate an estimated net increase of
26 2,000 to 3,000 spring-run or steelhead for spawning (Habitat Expansion

1 Threshold). The population size target of 2,000 to 3,000 spawning individuals
2 was selected because it is approximately the number of spring-run Chinook
3 Salmon and steelhead that historically migrated to the upper Feather River.
4 Endangered species issues will be addressed and documented on a specific project
5 basis for any restoration actions chosen and implemented under the Habitat
6 Expansion Agreement.

7 **3A.5.3.4.6 Anadromous Fish Monitoring on the Lower Feather River**

8 Until the new FERC license is issued and until a new monitoring program is
9 adopted, DWR will continue to monitor anadromous fish in the Lower Feather
10 River. As required in the SA (Article A101), within 3 years following the FERC
11 license issuance, DWR will develop a comprehensive Lower Feather River
12 Habitat Improvement Plan that will provide an overall strategy for managing the
13 various environmental measures developed for implementation, including the
14 implementation schedules, monitoring, and reporting. Each of the programs and
15 components of the Lower Feather River Habitat Improvement Plan will be
16 individually evaluated to assess the overall effectiveness of each action within the
17 Lower Feather River Habitat Improvement Plan.

18 **3A.5.3.5 Delta Field Division**

19 SWP facilities in the southern Delta include CCF, John E. Skinner Fish Facility,
20 and the Banks Pumping Plant. CCF is a 31 TAF reservoir located in the
21 southwestern edge of the Delta, about 10 miles northwest of the city of Tracy.
22 CCF provides storage to allow off-peak pumping of water exported through
23 Banks Pumping Plant, moderates the effect of the pumps on the fluctuation of
24 flow and stage in adjacent Delta channels, and collects sediment before it enters
25 the California Aqueduct. Diversions from Old River into CCF are regulated by
26 five radial gates.

27 **3A.5.3.5.1 John E. Skinner Delta Fish Protective Facility**

28 The John E. Skinner Delta Fish Protective Facility is located west of the CCF,
29 2 miles upstream of the Banks Pumping Plant. The Skinner Fish Facility screens
30 fish away from the pumps that lift water into the California Aqueduct. Large fish
31 and debris are directed away from the facility by a 388-foot long trash boom.
32 Smaller fish are diverted from the intake channel into bypasses by a series of
33 metal louvers, while the main flow of water continues through the louvers and
34 towards the pumps. These fish pass through a secondary system of screens and
35 pipes into seven holding tanks, where a subsample is counted and recorded. The
36 salvaged fish are then returned to the Delta in oxygenated tank trucks.

37 **3A.5.3.5.2 Harvey O. Banks Pumping Plant**

38 The Banks Pumping Plant is in the south Delta, about 8 miles northwest of Tracy
39 and marks the beginning of the California Aqueduct. The plant provides the
40 initial lift of water 244 feet into the California Aqueduct by means of 11 pumps,
41 including two rated at 375 cfs capacity, five at 1,130 cfs capacity, and four at

1 1,067 cfs capacity. The nominal capacity of the Banks Pumping Plant is
2 10,300 cfs.

3 Permits issued by the USACE regulate the rate of diversion of water into CCF for
4 pumping at Banks. This diversion rate is normally restricted to 6,680 cfs as a
5 three-day average inflow to CCF and 6,993 cfs as a one-day average inflow to
6 CCF. CCF diversions may be greater than these rates between December 15 and
7 March 15, when the inflow into CCF may be augmented by one-third of the
8 San Joaquin River flow at Vernalis when those flows are equal to or greater than
9 1,000 cfs.

10 *500 cfs Diversion Increase During July, August, and September*

11 During the months of July, August, and September, the maximum allowable daily
12 diversion rate into CCF was increased from 13,870 acre-feet to 14,860 acre-feet
13 and 3-day average diversions from 13,250 acre-feet to 14,240 acre-feet (500 cfs
14 per day equals 990 acre-feet per day). The increase in diversions was permitted in
15 2000, and was recently extended through 2016. The purpose of this diversion
16 increase into CCF for use by the SWP is to recover export reductions made due to
17 actions taken to benefit fisheries resources. The increased diversion rate does not
18 result in any increase in water supply deliveries above those that would occur in
19 the absence of the increased diversion rate. This increased diversion over the
20 3-month period could result in an amount not to exceed 90 TAF each year.

21 Variations to hydrologic conditions coupled with regulatory requirements may
22 limit the ability of the SWP to fully utilize the proposed increased diversion rate.
23 Also, facility capabilities may limit the ability of the SWP to fully utilize the
24 increased diversion rate.

25 Implementation of this action is contingent on meeting the following conditions.

- 26 • The increased diversion rate would not result in greater annual SWP water
27 supply allocations than would occur in the absence of the increased diversion
28 rate. Water pumped due to the increased capacity would only be used to
29 offset reduced diversions that occurred or would occur because of actions
30 taken to benefit fisheries.
- 31 • Use of the increased diversion rate would be in accordance with all terms and
32 conditions of existing BOs governing SWP operations.
- 33 • All three temporary agricultural barriers (Middle River, Old River near Tracy
34 and Grant Line Canal) must be in place and operating when SWP diversions
35 are increased.

36 Between July 1 and September 30, if the combined salvage of listed fish species
37 reaches a level of concern, the relevant fish regulatory agency would determine
38 whether the 500 cfs increased diversion is or continues to be implemented.

39 Other SWP-operated facilities in and near the Delta include the NBA, the South
40 Bay Aqueduct (SBA), the Suisun Marsh Salinity Control Gates (SMSCG),

1 Roaring River Distribution System (RRDS), and up to four temporary barriers in
2 the south Delta.

3 **3A.5.3.5.3 Clifton Court Forebay**

4 *Clifton Court Forebay Aquatic Weed Control Program*

5 Dense growth of submerged aquatic weeds in CCF, predominantly *Egeria densa*,
6 can cause severe head loss and pump cavitation at Banks Pumping Plant when the
7 stems of rooted plants break free, combine into “mats,” and drift into the trash
8 racks. This mass of uprooted and broken vegetation essentially forms a watertight
9 plug at the trash racks and vertical louver array. The resulting blockage
10 necessitates a reduction in the water pumping rate to prevent potential equipment
11 damage through pump cavitation. Cavitation creates excessive wear and
12 deterioration of the pump impeller blades. Excessive floating weed mats also
13 block the passage of fish into the Skinner Fish Facility, thereby reducing the
14 efficiency of fish salvage operations. Ultimately, this all results in a reduction in
15 the volume of water diverted by the SWP. Algal blooms in CCF are also
16 problematic because they degrade drinking water quality through tastes and odors
17 and production of algal toxins.

18 Beginning in 1995, DWR applied copper-based herbicide complexes to control
19 aquatic weeds and algal blooms in CCF. These herbicides included copper sulfate
20 pentahydrate, Komeen,[®] and Nautique[®]. These herbicides were applied on an as-
21 needed basis. Komeen[®] is a chelated copper herbicide (copper-ethylenediamine
22 complex and copper sulfate pentahydrate) and Nautique[®] is a copper carbonate
23 compound (see Sepro product labels).

24 The operational procedures for aquatic herbicide applications in CCF include:

- 25 • Apply aquatic pesticides as needed between July 1 and August 31.
- 26 • Monitor the salvage of listed fish at the Skinner Facility prior to the
27 application of the herbicides in CCF.
- 28 • Close the radial intake gates at the entrance to CCF 24 hours prior to the
29 application of herbicides to allow fish to move out of the proposed treatment
30 areas and towards the salvage facility.
- 31 • The radial gates would remain closed for 24 hours after treatment to allow for
32 at least 24 hours of contact time between the herbicide and the treated
33 vegetation in the forebay. Gates would be reopened after a minimum of
34 48 hours.
- 35 • Komeen[®] would be applied by boat, starting at the shore and moving
36 sequentially farther offshore in its application. Application would be made by
37 a certified water contractor under the supervision of a California Certified Pest
38 Control Advisor.
- 39 • Application of the herbicides would be to the smallest area possible that
40 provides relief to SWP operations.

- 1 • Monitoring of the water column concentrations of copper is proposed during
2 and after herbicide application. No monitoring of the copper concentration in
3 the sediment or detritus is proposed.
- 4 Due to concerns that the pesticide treatments may adversely affect Green
5 Sturgeon, during 2006 DWR ceased using aquatic pesticides and employed the
6 use of a mechanical aquatic weed harvester.
- 7 If DWR resumes herbicide treatments in the CCF, they would occur only in July
8 and August on an as-needed basis dependent upon the level of vegetation biomass
9 in the enclosure. It is not possible to predict future CCF conditions with climate
10 change. However, the frequency of herbicide applications is not expected to
11 occur more than twice per year, as demonstrated by the history of past
12 applications. Herbicides are typically applied early in the growing season when
13 plants are susceptible to them during rapid growth and formation of plant tissues;
14 or later in the season, when plants are mobilizing energy stores from their leaves
15 towards their roots for overwintering senescence.
- 16 Aquatic weed management problems in CCF have historically been limited to
17 about 700 acres of the 2,180 total water surface acres. Application of the
18 herbicide during 1995–2006 was limited to only those areas in CCF that require
19 treatment. The copper-based herbicides, Komeen[®] or Nautique, were applied by
20 helicopter or boat to only those portions where aquatic weeds presented a
21 management problem to the State.
- 22 Historically, algal problems in CCF have been caused by attached benthic
23 cyanobacteria that produce unpleasant tastes and odors in the domestic drinking
24 water derived from the SWP operations. Copper sulfate is applied to the
25 nearshore areas of CCF when results of solid phase microextraction (American
26 Public Health Association, American Water Works Association, and Water
27 Environment Federation 2005) analysis exceed the control tolerances
28 (2-methylisoborneol [MIB] < 5 nanograms per liter [ng/L] and geosmin < 10 ng/L
29 are not detected by consumers in drinking water supplies) (California Department
30 of Water Resources 2013). Geosmin and MIB are natural byproducts of algal
31 chlorophyll production. Highest biomass of taste- and odor-producing
32 cyanobacteria was present in the nearshore areas but not limited to shallow
33 benthic zone. Historically, application areas varied considerably based on the
34 extent of the algal infestation in CCF.
- 35 DWR receives Clean Water Act pollutant discharge coverage under the National
36 Pollutant Discharge Elimination System (NPDES) Permit No. CAG990005
37 (General Permit) issued by SWRCB for application of aquatic pesticides to the
38 SWP's aqueducts, forebays, and reservoirs. SWRCB functions as the USEPA's
39 non-federal representative for implementation of the Clean Water Act in
40 California.
- 41 A Mitigated Negative Declaration was prepared by DWR to comply with CEQA
42 requirements associated with regulatory requirements established by SWRCB.
43 DWR, a public entity, was granted a Section 5.3 Exception by SWRCB (Water

1 Quality Order 2004-0009-DWQ). Under the exception, DWR is not required to
2 meet the copper limitation in receiving waters defined in DWR's Aquatic
3 Pesticide Application Plan as occurring on an as-needed basis during the year,
4 after other options have been exhausted.

5 **3A.5.3.5.4 Proposed Measures to Reduce Fish Mortality**

6 DWR plans to implement a number of projects to reduce fish mortality, including
7 (1) implementing the CCF Fishing Facility Project, (2) improving fish conditions
8 at the Curtis Landing Fish Release Site, (3) constructing a Fish Science Building
9 for fish studies, (4) building two new release sites, (5) developing a CVP and
10 SWP coordinated fish release plan, and (6) improving herbicide application
11 procedures to protect listed species.

12 DWR plans to implement the CCF Fishing Facility Project to reduce salmon and
13 steelhead pre-screen losses in CCF by (a) building a concrete support pad to
14 improve crane maintenance of the radial gates, (b) improve angler access and
15 conditions to reduce the number of predators affecting listed species, and
16 (c) increase security operations.

17 DWR plans to rebuild the Curtis Landing fish release site to reduce salmon
18 predation by; (a) building a larger pump to more effectively flush salvaged fish,
19 (b) screening the water pump to prevent fish entrainment, and (c) building two
20 release sites with improved facilities to improve fish releases and lengthen time
21 between using repeated release sites.

22 DWR plans to open a Fish Science Building and storage warehouse at Skinner
23 Fish Salvage Facility in order to conduct fisheries studies in support of improving
24 endangered species protection for the State Water Project. The facilities would
25 support; (a) the CCF Predation Study, (b) the Skinner Release Site Efficiency
26 Study, (c) Acoustic Tagging Study, and (d) future studies related to the State
27 Water Project.

28 DWR plans to build two new fish release sites that will help lengthen out the
29 rotation time between release locations and will assist in reducing listed species
30 predation at release sites. Facilities were created at Little Baja and Manzo Ranch
31 on Sherman Island.

32 If DWR resumes application of Komeen[®] (copper-ethylenediamine complex) or
33 similar aquatic herbicides, it would be applied according to the manufacturer's
34 instructions, following the operational procedures described in Table P-24,
35 Section 6.6.3 of the 2009 NMFS BO, and in accordance with state and federal
36 law. CCF elevation would be raised to +2 feet above mean sea level for an
37 average depth of about 6 feet within the maximum 700-water surface acre
38 treatment zone. The herbicide would be applied at a rate of 13 gallons per surface
39 acre to achieve a final operational concentration in the water body of 0.64 mg/L
40 Cu²⁺ (640 parts per billion [ppb]). The application rate of 13 gallons per surface
41 acre is calculated based on mean depth. The product label allows applications up
42 to 1 mg/L (1,000 ppb or 1 ppm). DWR would apply Komeen[®] in accordance with

1 the product label that states, “If treated water is a source of potable water, the
2 residue of copper must not exceed 1 ppm (mg/L).”

3 In 2005, 770 surface acres were treated with Komeen[®]. CCF has a mean depth of
4 6 feet at 2 feet above mean sea level; thus the volume treated was 4,620 af.

5 The calculated concentration of Cu²⁺ for the 2005 application was 0.65 mg/L
6 Cu²⁺. The copper level required to control *Egeria densa* (the main component of
7 the CCF aquatic plant community) is 0.5–0.75 mg/L Cu²⁺. Source: Komeen[®]
8 Specimen Label.

9 Toxicity testing and literature review of LC-50 levels for salmon, steelhead, Delta
10 Smelt, and Green Sturgeon were conducted. Copper-complexes are generally
11 much less toxic to fish than the inorganic copper salts, including copper sulfate.
12 Once applied, the initial stock copper concentration is reduced rapidly by dilution,
13 plant uptake, and adsorption to particulate matter. The half-life for the
14 commercial copper-complexes is very short for the copper-EDA complexes
15 (0.07 to 0.18 days). Komeen[®] applied according to the Specimen Label
16 (SePro Corporation) in the receiving water would achieve final concentration
17 levels. Based on the treatment elevation of +2 feet, only about 20 percent
18 (4,630 af) of the 22,665 acre-feet CCF would be treated. If herbicide treatments
19 resume, the copper would be applied beginning on one side of the CCF allowing
20 fish to move out of the treatment area. In addition, Komeen[®] would be applied
21 from boats at a slower rate than in previous years when a helicopter was used.

22 **3A.5.3.6 South Bay Aqueduct**

23 The SBA conveys water from the Delta through over 40 miles of pipelines and
24 canals to the Zone 7 Water Agency, Alameda County, and Santa Clara Valley
25 Water Districts, which in turn provide service to the cities of Livermore, Dublin,
26 Pleasanton, San Ramon, Fremont, Newark, Union City, Milpitas, Santa Clara,
27 and San Jose. The SBA was the first conveyance facility constructed for the SWP
28 and was designed for a capacity of 300 cfs. The facility is currently being
29 upgraded to increase the capacity to 430 cfs to meet Zone 7 Water Agency’s
30 future needs and provide operational flexibility to reduce SWP peak power
31 consumption. Modeling of this facility uses the full 430 cfs capacity.

32 **3A.5.3.7 North Bay Aqueduct Intake at Barker Slough**

33 The Barker Slough Pumping Plant (BSPP) diverts water from Barker Slough into
34 the NBA for delivery to the Solano County Water Agency (SCWA) and the Napa
35 County Flood Control and Water Conservation District (Napa County FC&WCD)
36 (NBA water contractors).

37 The NBA intake is located approximately 10 miles from the main stem
38 Sacramento River at the end of Barker Slough. Delta Smelt monitoring is
39 required at Barker Slough.

40 The existing NBA system has several existing and potential future limitations, as
41 described in the following section.

1 **3A.5.3.7.1 Existing Limitations**

2 *Water Quality*

3 Water quality in Barker Slough becomes degraded during winter and spring
4 rainfall events. The Barker Slough drainage basin is characterized by grazing
5 lands, erodible soils, and urban uses. Rainfall runoff can include elevated levels
6 of coliform bacteria, organic matter, turbidity, and pollutants. The water is costly
7 to treat to meet drinking water standards.

8 *Pumping Restrictions*

9 The NBA SWP water contractors have an existing water supply through the NBA
10 of 131,181 acre-feet per year based on existing contracts and water right
11 settlements. The 2008 USFWS BO limited the total SWP annual diversion at the
12 BSPP to approximately 71 TAF. In 2009, an incidental take permit issued CDFW
13 for the preservation of longfin smelt populations imposed further pumping
14 restrictions at the BSPP of a maximum of 50 cfs (7-day average flows) during dry
15 and critical dry years from January 15 to March 31.

16 *Water Supply Delivery Limitations*

17 The NBA system had the design capacity of 175 cfs, provided all 10 pumps were
18 installed at BSPP. There are currently only nine pumps (seven large, two small)
19 at BSPP. Installation of the tenth pump was deferred, resulting in the current
20 design capacity of 162.5 cfs. However, until late 2011, the system delivered a
21 maximum of only 140 cfs due to thick bio-film growth on the interior of the NBA
22 pipeline, which reduced the effective diameter of the pipe. In October 2011,
23 maximum allowable pumping at BSPP was further reduced to keep the pressure in
24 the pipeline within acceptable limits.

25 **3A.5.3.7.2 Potential Future Limitations**

26 *Pumping Restrictions*

27 The pumping capacity of the existing NBA system could be subjected to
28 additional restrictions in the future. In June 2009, NMFS issued a BO that
29 included determinations for winter and spring-run Chinook Salmon, Central
30 Valley Steelhead and North American Green Sturgeon of the southern distinct
31 population segment. State and federal agencies working on ways to improve the
32 Delta ecosystem and water supply conveyance, including work under the Bay
33 Delta Conservation Plan (BDCP), have identified the Yolo Bypass and Cache
34 Slough Complex as important Wetlands Restoration Opportunity Areas.
35 Implementing these developing strategies would likely support increases in Delta
36 Smelt, longfin smelt and salmonid populations in the Barker Slough area. The
37 increased presence of these listed species could result in further pumping
38 restrictions at the BSPP as resource agencies work to balance ecosystem
39 restoration and water supply delivery goals.

1 *Projected Water Delivery Demands*

2 The NBA SWP water contractors project that by 2030 they would need the NBA
3 to deliver their total water supply of 131,181 af/year (compared to current
4 withdrawal of 71 TAF/year). To meet projected future demand, required peak
5 flow through the NBA is estimated at 240 cfs.

6 **3A.6 Coordinated Facilities of the CVP and SWP**

7 **3A.6.1 Joint Project Facilities**

8 **3A.6.1.1 Suisun Marsh**

9 Since the early 1970s, the California Legislature, SWRCB, Reclamation, CDFW,
10 Suisun Resource Conservation District (SRCD), DWR, and other agencies have
11 worked to preserve beneficial uses of Suisun Marsh in mitigation for perceived
12 impacts of reduced Delta outflow on the salinity regime. Early on, salinity
13 standards were set by SWRCB to protect alkali bulrush production, a primary
14 waterfowl plant food. The most recent standard under SWRCB D-1641
15 acknowledges that multiple beneficial uses deserve protection.

16 A contractual agreement among DWR, Reclamation, CDFW, and SRCD contains
17 provisions for DWR and Reclamation to mitigate the effects on Suisun Marsh
18 channel water salinity from SWP and CVP operations and other upstream
19 diversions. The Suisun Marsh Preservation Agreement (SMPA) requires DWR
20 and Reclamation to meet salinity standards, sets a timeline for implementing the
21 Plan of Protection, and delineates monitoring and mitigation requirements. In
22 addition to the contractual agreement, SWRCB D-1485 codified salinity standards
23 in 1978, which have been carried forward to SWRCB D-1641.

24 There are two primary physical mechanisms for meeting salinity standards set
25 forth in SWRCB D-1641 and the SMPA: (1) the implementation and operation of
26 physical facilities in the Marsh; and (2) management of Delta outflow
27 (i.e., facility operations are driven largely by salinity levels upstream of
28 Montezuma Slough and salinity levels are highly sensitive to Delta outflow).
29 Physical facilities (described below) have been operating since the early 1980s
30 and have proven to be a highly reliable method for meeting standards. However,
31 since Delta outflow cannot be actively managed by the Suisun Marsh Program,
32 Marsh facility operations must be adaptive in response to changing salinity levels
33 in the Delta.

34 **3A.6.1.1.1 Suisun Marsh Wildlife Habitat Management, Preservation, and**
35 **Restoration Plan**

36 Reclamation, USFWS, CDFW, and federal and state agencies developed the
37 Suisun Marsh Habitat Management, Preservation, and Restoration Plan (SMP).
38 The SMP is to restore 5,000 to 7,000 acres of managed wetland activities in
39 30 years. The SMP preserves and enhances managed seasonal wetlands,
40 implement a comprehensive levee protection/improvement program, and protect

1 ecosystem and drinking water quality, while restoring habitat for tidal
2 marsh-dependent sensitive species.

3 In June of 2013, USFWS issued a BO on the SMP based on the project
4 description that includes program-level tidal wetland restoration of 5,000 to
5 7,000 acres. An overview of the expected outcomes of tidal restoration is
6 presented, but specific site locations and other details are not included. As sites
7 are identified, and there is sufficient detail about the nature, scope, location, and
8 timing of the restoration actions, the USFWS will review that information. If the
9 site-specific tidal restoration plans are consistent with the SMP and USFWS-
10 issued biological opinions, USFWS will append the project to the PBO and
11 provide an incidental take statement. If a tidal restoration project has potential
12 effects on listed species beyond those analyzed in the PBO, planning efforts for
13 those projects will include site-specific consultation under the ESA with USFWS.

14 Requirements for proposed tidal marsh restoration project to be appended to the
15 PBO are as follows. The proposed tidal marsh restoration project must:

- 16 • Be within the SMP area.
- 17 • Not exceed the acreage evaluated in the SMP; Note, this project does not
18 preclude additional restoration activities from occurring in Suisun Marsh that
19 are not specifically addressed in this BO. Separate environmental permitting
20 would be needed for these projects.
- 21 • Follow the SMP site selection considerations.
- 22 • Follow the conservation measures and reporting (per the PBO).
- 23 • Be reviewed and approved by USFWS and CDFW.
- 24 • Be reviewed by the Suisun Adaptive Management Advisory Team and the
25 SMP Principals.

26 **3A.6.1.1.2 Suisun Marsh Salinity Control Gates**

27 The SMSCG are located on Montezuma Slough about two miles downstream
28 from the confluence of the Sacramento and San Joaquin Rivers, near Collinsville.
29 The objective of Suisun Marsh Salinity Control Gate operation is to decrease the
30 salinity of the water in Montezuma Slough. The gates control salinity by
31 restricting the flow of higher salinity water from Grizzly Bay into Montezuma
32 Slough during incoming tides and retaining lower salinity Sacramento River water
33 from the previous ebb tide. Operation of the gates in this fashion lowers salinity
34 in Suisun Marsh channels and results in a net movement of water from east
35 to west.

36 When Delta outflow is low to moderate and the gates are not operating, tidal flow
37 past the gate is approximately 5,000 to 6,000 cfs while the net flow is near zero.
38 When operated, flood tide flows are arrested while ebb tide flows remain in the
39 range of 5,000 to 6,000 cfs. The net flow in Montezuma Slough becomes
40 approximately 2,500 to 2,800 cfs. The USACE permit for operating the SMSCG

1 requires that it be operated between October and May only when needed to meet
2 Suisun Marsh salinity standards. Historically, the gate has been operated as early as
3 as October 1, although in some years (e.g., 1996) the gate was not operated at all.
4 When the channel water salinity decreases sufficiently below the salinity
5 standards, or at the end of the control season, the project provides unrestricted
6 movement through Montezuma Slough. Details of annual gate operations can be
7 found in *Summary of Salinity Conditions in Suisun Marsh During Water Years*
8 1984–1992 (California Department of Water Resources 1994), or the Suisun
9 Marsh Monitoring Program Data Summary produced annually by DWR’s
10 Division of Environmental Services.

11 The approximately 2,800 cfs net flow induced by SMSCG operation is effective
12 at moving the salinity downstream in Montezuma Slough. Salinity is reduced by
13 roughly 100 percent at Belden’s Landing, and by lesser amounts farther west
14 along Montezuma Slough. At the same time, the salinity field in Suisun Bay
15 moves upstream as net Delta outflow (measured nominally at Chipps Island) is
16 reduced by gate operation. Net outflow through Carquinez Strait is not affected.

17 The SMSCG are operated during the salinity control season, which spans from
18 October to May. Operational frequency is affected by hydrologic conditions,
19 weather, Delta outflow, tide, fishery considerations, and other factors. The gates
20 have also been operated for scientific studies. After discussions with NMFS
21 based on study findings, the boat lock portion of the gate is now held open at all
22 times during SMSCG operation to allow for continuous salmon passage
23 opportunity. Adaptive management of the gates continues to improve and salinity
24 standards have been met with less frequent gate operation since 2006. In low
25 outflow years gate operation was used from 35 to 42 days. The operation was
26 limited to 17 to 69 days in 2009, 2010, 2011 and 2013. Assuming no significant
27 long-term changes in the drivers mentioned above, it is expected that gate
28 operations will remain at current levels (17 to 69 days per year) except perhaps
29 during the most critical hydrologic conditions and other conditions that affect
30 Delta outflow.

31 **3A.6.1.1.3 SMSCG Fish Passage Study**

32 The SMSCG were constructed and operate under USACE Permit 16223E58,
33 which includes a special condition to evaluate the nature of delays to migrating
34 fish. Ultrasonic telemetry studies in 1993 and 1994 showed that the physical
35 configuration and operation of the gates during the control season have a negative
36 effect on adult salmonid passage (Tillman et al. 1996; Edwards et al. 1996).

37 The Department coordinated additional fish passage studies in 1998, 1999, 2001,
38 2002, 2003, and 2004. Migrating adult fall-run Chinook Salmon were tagged and
39 tracked by telemetry in the vicinity of the SMSCG to assess potential measures to
40 increase the salmon passage rate and decrease salmon passage time through the
41 gates.

1 Results in 2001, 2003, and 2004 indicate that leaving the boat lock open during
2 the Control Season when the flashboards are in place at the SMSCG and the radial
3 gates are tidally operated provides a nearly equivalent fish passage to the non-
4 control season configuration when the flashboards are out and the radial gates are
5 open. This approach minimizes delay and blockage of adult Sacramento River
6 winter-run Chinook Salmon, Central Valley spring-run Chinook Salmon, and
7 Central Valley Steelhead migrating upstream during the Control Season while the
8 SMSCG is operating. However, the boat lock gates may be closed temporarily to
9 stabilize flows to facilitate safe passage of watercraft through the facility.

10 Reclamation and DWR are continuing to coordinate with the SMSCG Steering
11 Committee in identifying water quality criteria, operational rules, and potential
12 measures to facilitate removal of the flashboards during the control season that
13 would provide the most benefit to migrating fish. However, the flashboards
14 would not be removed during the control season unless it was certain that
15 standards would be met for the remainder of the control season without the
16 flashboards installed.

17 **3A.6.1.1.4 Roaring River Distribution System**

18 The RRDS was constructed during 1979 and 1980 as part of the Initial Facilities
19 in the Plan of Protection for the Suisun Marsh. The system was constructed to
20 provide lower salinity water to 5,000 acres of private and 3,000 acres of CDFW
21 managed wetlands on Simmons, Hammond, Van Sickle, Wheeler, and Grizzly
22 Islands.

23 The RRDS includes a 40-acre intake pond that supplies water to Roaring River
24 Slough. Motorized slide gates in Montezuma Slough and flap gates in the pond
25 control flows through the culverts into the pond. A manually operated flap gate
26 and flashboard riser are located at the confluence of Roaring River and
27 Montezuma Slough to allow drainage back into Montezuma Slough for
28 controlling water levels in the distribution system and for flood protection. DWR
29 owns and operates this drain gate to ensure the Roaring River levees are not
30 compromised during extremely high tides.

31 Water is diverted through a bank of eight 60-inch-diameter culverts equipped with
32 fish screens into the Roaring River intake pond on high tides to raise the water
33 surface elevation in RRDS above the adjacent managed wetlands. Managed
34 wetlands north and south of the RRDS receive water, as needed, through publicly
35 and privately owned turnouts on the system.

36 The intake to the RRDS is screened to prevent entrainment of fish larger than
37 approximately 25 mm. DWR designed and installed the screens based on CDFW
38 criteria. The screen is a stationary vertical screen constructed of continuous-slot
39 stainless steel wedge wire. All screens have 3/32 inch slot openings. After the
40 listing of Delta Smelt, RRDS diversion rates have been controlled to maintain an
41 average approach velocity below 0.2 ft/s at the intake fish screen. Since 1996, the
42 motorized slide gates have been operated remotely to allow hourly adjustment of
43 gate openings to maximize diversion throughout the tide.

1 DWR conducts routine maintenance of the system, primarily maintaining the
2 levee roads and fish screens. RRDS, like other levees in the marsh, have
3 experienced subsidence since it was constructed in 1980. In 1999, DWR restored
4 all 16 miles of levees to design elevation as part of damage repairs following the
5 1998 flooding in Suisun Marsh. In 2006, portions of the north levee were
6 repaired to address damage following the January 2006 flooding.

7 **3A.6.1.1.5 Morrow Island Distribution System**

8 The Morrow Island Distribution System (MIDS) was constructed in 1979 and
9 1980 in the southwestern Suisun Marsh as part of the Initial Facilities in the Plan
10 of Protection for the Suisun Marsh. The contractual requirement for Reclamation
11 and DWR is to provide water to the ownerships so that lands may be managed
12 according to approved local management plans. The system was constructed
13 primarily to channel drainage water from the adjacent managed wetlands for
14 discharge into Suisun Slough and Grizzly Bay. This approach increases
15 circulation and reduces salinity in Goodyear Slough.

16 The MIDS is used year-round, but most intensively from September through June.
17 When managed wetlands are filling and circulating, water is tidally diverted from
18 Goodyear Slough just south of Pierce Harbor through three 48-inch culverts.
19 Drainage water from Morrow Island is discharged into Grizzly Bay by way of the
20 C-Line Outfall (two 36-inch culverts) and into the mouth of Suisun Slough by
21 way of the M-Line Outfall (three 48-inch culverts), rather than back into
22 Goodyear Slough. This helps prevent increases in salinity due to drainage water
23 discharges into Goodyear Slough. The M-Line ditch is approximately 1.6 miles
24 long and the C-Line ditch is approximately 0.8 miles long.

25 The 1997 USFWS BO issued for dredging of the facility included a requirement
26 for screening the diversion to protect Delta Smelt. DWR and Reclamation are
27 currently analyzing conservation alternatives to a fish screen in coordination with
28 USFWS and CDFW to meet BO requirements.

29 Studies suggest that Goodyear Slough is a marginal, rarely used habitat for
30 special-status fishes. Therefore, implementing other tidal restoration projects
31 elsewhere may be more beneficial and practical than fish screening. Restoration
32 of tidal wetland ecosystems is expected to aid in the recovery of several listed and
33 special status species within the marsh and improve food availability for Delta
34 Smelt and fish.

35 There are currently no plans to modify operations.

36 **3A.6.1.2 South Delta Temporary Barriers Project**

37 DWR initiated the South Delta Temporary Barrier Project (TBP) in 1991. Permit
38 extensions under Section 404 of the Clean Water Act were granted in 1996, 2001,
39 2008 and 2011, when DWR obtained permits to extend the Temporary Barriers
40 Project through 2016. The current TBP PBO issued in 2014 by USFWS to
41 USACE allows for permit issuance for construction and demolition through 2017.
42 This allows the USACE to issue a 5-year 505 permit for the agricultural barriers

1 and Head of Old River Barrier. NMFS issued annual BOs to USACE to provide
2 incidental take coverage for permitting the construction of the TBP in 2011 and
3 2012. In 2013 a PBO was issued to USACE providing incidental take coverage
4 for permitting through 2017. State permits including the Incidental Take Permit
5 and Streambed Alteration Agreement from CDFW and the 401 Water Quality
6 Certification from the Regional Water Quality Control Board, provide coverage
7 through 2016. The project consists of four rock barriers across south Delta
8 channels. In various combinations, these barriers improve water levels and San
9 Joaquin River salmon migration in the south Delta. The existing TBP consists of
10 installation and removal of temporary rock barriers at the following locations.

- 11 • Middle River near Victoria Canal, about 0.5 miles south of the confluence of
12 Middle River, Trapper Slough, and North Canal.
- 13 • Old River near Tracy, about 0.5 miles east of the DMC intake.
- 14 • Grant Line Canal near Tracy Boulevard Bridge, about 400 feet east of Tracy
15 Boulevard Bridge.
- 16 • The head of Old River at the confluence of Old River and San Joaquin River.

17 The barriers on Middle River, Old River near Tracy, and Grant Line Canal are
18 flow control facilities designed to improve water levels for agricultural diversions
19 and are in place during the irrigation season. South Delta Temporary Barriers are
20 operated based on San Joaquin flow conditions. Head of Old River Barrier is
21 only installed from September 16th to November 30th and is no longer installed
22 in the spring months per 2008 USFWS Delta Smelt BO Action 5. Operation of
23 the agricultural barriers at Middle River and Old River near Tracy can begin as
24 early as April 15. From May 16 to May 31 (if the barrier at the head of Old River
25 is removed) the tide gates are tied open in the barriers in Middle River and Old
26 River near Tracy. After May 31, the barriers in Middle River, Old River near
27 Tracy, and Grant Line Canal are permitted to be operational until they are
28 completely removed by November 30.

29 During the spring, the barrier at the head of Old River is designed to reduce the
30 number of out-migrating salmon smolts entering Old River. During the fall, this
31 barrier is designed to improve flow and DO conditions in the San Joaquin River
32 for the immigration of adult fall-run Chinook Salmon. The barrier at the head of
33 Old River barrier is typically in place from April 15 to May 15 for the spring, and
34 from early September to late November for the fall. Installation and operation of
35 the barrier at the head of Old River also depends on the San Joaquin River flow
36 conditions.

37 In addition to permitting construction and removal of the barriers, the permits also
38 give DWR coverage for scientific studies that may take endangered fish species.
39 According to NMFS and USFWS BO requirements, actions for each upcoming
40 year—including barrier type, timing, and any scientific studies planned—must be
41 submitted to the USACE by October 1 of each year. USACE requests of NMFS
42 and USFWS that the actions for the upcoming year be appended to the PBOs.

1 In 2009 and 2010, an experimental non-physical barrier was installed in lieu of
2 the HOR spring rock barrier with the intention of deterring out-migrating juvenile
3 salmonids from entering Old River. This experimental barrier is a patented
4 technology using sound and light as a deterrent. Although high flows prohibited
5 installation of the non-physical barrier in 2011, a without-barrier study of predator
6 behavior was conducted. In 2012, a rock barrier with eight culverts was installed
7 in the spring as a component of a fish-monitoring study designed to inform export
8 operations. The rock barrier with eight culverts is expected to be installed each
9 spring unless installation is prevented by high flows in the San Joaquin River, or
10 if new studies conclude the spring HOR barrier does not provide salmonid
11 protections previously assumed.

12 To improve water circulation and quality, DWR in coordination with the South
13 Delta Water Agency and Reclamation, began in 2007 to manually tie open the
14 culvert flap gates at the Old River near Tracy barrier to improve water circulation
15 and untie them when water levels fell unacceptably. This operation is expected to
16 continue in subsequent years as needed to improve water quality. In addition,
17 DWR consulted with USACE and received USFWS and NMFS approval to raise
18 the Middle River weir height by 1 foot. The weir height will be raised during the
19 summer irrigation season only after Delta Smelt concerns have passed. The
20 requested modification was approved late in the 2010 irrigation season. The weir
21 was raised in 2012. It was not raised in 2011 due to high flow conditions in the
22 south Delta.

23 In the absence of permanent operable gates, the TBP would continue as planned
24 and permitted. Computer model forecasts, real-time monitoring, and coordination
25 with local, state, and federal agencies and stakeholders would help determine if
26 the temporary rock barriers operations need to be modified during the transition
27 period.

28 **3A.6.1.2.1 Conservation Strategies and Mitigation Measures**

29 DWR has complied with the various measures and conditions required by
30 regulatory agencies under past and current permits to avoid, minimize, and
31 compensate for the TBP impacts. An ongoing monitoring plan is implemented
32 each year the barriers are installed and an annual monitoring report is prepared to
33 summarize the activities. The monitoring elements include fisheries monitoring
34 and water quality analysis, salmon smolt survival investigations, barrier effects on
35 SWP and CVP entrainment, Swainson's Hawk monitoring, water elevation, water
36 quality sampling, and hydrologic modeling. DWR operates fish screens to offset
37 TBP impacts at Sherman Island. Studies of predator behavior in the vicinity of
38 the non-physical barrier began in 2011 as required by CDFW.

39 The 2008 NMFS BO for the TBP requires a fisheries monitoring program using
40 biotelemetry techniques to examine the movements and survival of juvenile
41 salmon and juvenile steelhead through the channels of the south Delta. The BO
42 also requires that predation effects associated with the barriers be examined.
43 Information gained as part of the 2009 pilot study was used to develop the full

1 scale study that started in 2010. 2011 was the third and final year of the studies
2 mandated in the 2008 BO. Any future telemetry studies at the barriers would be
3 required from a subsequent BO.

4 The CDFW incidental take permit provides California Endangered Species
5 coverage through 2016. This permit requires 6 acres of shallow water habitat that
6 have been provided through a purchase from the Wildlands Liberty Island
7 mitigation bank.

8 **3A.6.2 Delta-Mendota Canal/California Aqueduct Intertie**

9 The DMC/California Aqueduct Intertie was completed in 2012. The project
10 consists of a pumping plant and pipeline connections between the DMC and the
11 California Aqueduct. The DMC/California Aqueduct Intertie Pumping Plant is
12 located at DMC milepost 7.2 where the DMC and the California Aqueduct are
13 about 500 feet apart.

14 The DMC/California Aqueduct Intertie achieves multiple benefits, including
15 meeting current water supply demands, allowing for the maintenance and repair
16 of the CVP Delta export and conveyance facilities, and providing operational
17 flexibility to respond to emergencies. The Intertie allows flow in both directions,
18 which would provide additional flexibility to both CVP and SWP operations. The
19 Intertie includes a pumping plant at the DMC that allows up to 467 cfs to be
20 pumped from the DMC to the California Aqueduct. Up to 900 cfs can be
21 conveyed from the California Aqueduct to the DMC using gravity flow.

22 The DMC/California Aqueduct Intertie is operated by the San Luis and Delta-
23 Mendota Water Authority (Authority). Agreements between Reclamation, DWR,
24 and the Authority identify the responsibilities and procedures during operation of
25 the DMC/California Aqueduct Intertie.

26 **3A.6.2.1 Operations**

27 The DMC/California Aqueduct Intertie can be used under three different
28 scenarios:

- 29 • Up to 467 cfs may be pumped from the DMC to the California Aqueduct to
30 ease DMC conveyance constraints and help meet water supply demands of
31 CVP contractors. This would allow Jones Pumping Plant to pump to its
32 design capacity of up to 4,600 cfs, subject to all applicable export pumping
33 restrictions for water quality and fishery protections.
- 34 • Up to 467 cfs may be pumped from the DMC to the California Aqueduct to
35 minimize impacts on water deliveries due to temporary restrictions in flow or
36 water levels on the lower DMC (south of the Intertie) or the upper California
37 Aqueduct (north of the Intertie) for system maintenance or due to an
38 emergency shutdown.
- 39 • Up to 900 cfs may be conveyed from the California Aqueduct to the DMC
40 using gravity flow to minimize impacts on water deliveries due to temporary
41 restrictions in flow or water levels on the lower California Aqueduct (south of

1 the Intertie) or the upper DMC (north of the Intertie) for system maintenance
2 or for an emergency shutdown.

3 The DMC/California Aqueduct Intertie provides operational flexibility between
4 the DMC and California Aqueduct. It would not result in any changes to
5 authorized pumping capacity at Jones Pumping Plant or Banks Pumping Plant.

6 Water conveyed at the DMC/California Aqueduct Intertie to minimize reductions
7 to water deliveries during system maintenance or an emergency shutdown on the
8 DMC or California Aqueduct can include pumping of CVP water at Banks
9 Pumping Plant or SWP water at Jones Pumping Plant through use of JPOD. In
10 accordance with COA Articles 10(c) and 10(d), JPOD may be used to replace
11 conveyance opportunities lost because of scheduled maintenance, or unforeseen
12 outages. Use of JPOD for this purpose can occur under Stage 2 operations
13 defined in SWRCB D-1641, or could occur as a result of a SWRCB Temporary
14 Urgency request. Use of JPOD in this case does not result in any net increase in
15 allowed exports at CVP and SWP export facilities. When in use, water within the
16 DMC is conveyed to the California Aqueduct via the Intertie to O'Neill Forebay.

17 **3A.6.3 Transfers**

18 California Water Law and the CVPIA promote water transfers as important water
19 resource management measures to address water shortages provided certain
20 protections to source areas and users are incorporated into the water transfer.
21 Parties seeking water transfers generally acquire water from sellers who have
22 available surface water who can make the water available through releasing
23 previously stored water, pump groundwater instead of using surface water; fallow
24 crops or substitute a crop that uses less water in order to reduce normal
25 consumptive use of surface diversions.

26 Water transfers (addressed in this document) occur when a water right holder
27 within the Sacramento-San Joaquin River watershed undertakes actions to make
28 water available for transfer. The SWP does not address the upstream operations
29 that may be necessary to make water available for transfer. Nor does this
30 document address the impacts of water transfers on terrestrial species.

31 Transfers requiring export from the Delta are done at times when pumping and
32 conveyance capacity at the CVP or SWP export facilities is available to move the
33 water to the buyer. Additionally, Reclamation and DWR must coordinate review
34 of the transfer proposals and Project operations to assure that the Projects are not
35 impacted including the ability to exercise their own water rights or to meet their
36 legal and regulatory requirements are not diminished or limited in any way. To
37 avoid impacts to Delta water quality the individual transfer is assessed a carriage
38 water loss to account for flows required to avoid impacts to Delta water quality or
39 flow objectives. All transfers would be in accordance with all existing regulations
40 and requirements.

1 Purchasers of water for transfers may include Reclamation, CVP water
2 contractors, DWR, SWP water contractors, other State and Federal agencies, and
3 other parties. Reclamation and DWR have operated water acquisition programs
4 in the past to provide water for environmental programs and additional supplies to
5 CVP water contractors, SWP water contractors, and other parties. Past transfer
6 programs include the following.

- 7 • DWR administered the 1991, 1992, 1994, and 2009 Drought Water Banks and
8 Dry Year Programs in 2001 and 2002.
- 9 • Reclamation operated a forbearance program in 2001 by purchasing CVP
10 contractors' water in the Sacramento Valley for CVPIA instream flows, and to
11 augment water supplies for CVP contractors south of the Delta and wildlife
12 refuges. Reclamation administers the CVPIA Water Acquisition Program for
13 Refuge Level 4 supplies and fishery instream flows.
- 14 • DWR is a signatory to the Yuba River Accord Water Transfer Agreement
15 through 2025 that provides fish flows on the Yuba River and also water
16 supply that is exported at DWR and Reclamation Delta facilities for the CVP
17 and SWP operations and for the SWP and CVP contractors.
- 18 • In the past, CVP contractors and SWP water contractors have independently
19 acquired water and arranged for pumping and conveyance through SWP and
20 CVP facilities.

21 **3A.6.3.1 Lower Yuba River Accord**

22 The Lower Yuba River Accord (Yuba Accord) consists of three sets of
23 agreements designed to protect and enhance fisheries resources in the Lower
24 Yuba River, increase local water supply reliability, provide DWR with increased
25 operational flexibility for protection of Delta fisheries resources, and provide
26 added dry-year water supplies to CVP and SWP water contractors. These
27 agreements are:

- 28 • The Lower Yuba River Fisheries Agreement (Fisheries Agreement).
- 29 • Agreements for the Conjunctive Use of Surface and Groundwater Supplies
30 (Conjunctive Use Agreements).
- 31 • Agreement for the Long-term Purchase of Water from Yuba County Water
32 Agency by DWR (Water Purchase Agreement).

33 The Fisheries Agreement is the cornerstone of the Yuba Accord. It was
34 developed by state, federal, and consulting fisheries biologists, fisheries
35 advocates, policy representatives, and the Yuba County Water Agency (YCWA).
36 Compared to the interim flow requirements of the SWRCB Revised Water Right
37 Decision 1644 (RD-1644), the Fisheries Agreement establishes higher minimum
38 instream flows during most months of most water years.

1 To assure that YCWA's water supply reliability is not reduced by the higher
2 minimum instream flows and water transfers, it and seven of its member units
3 have signed conjunctive use agreements. These agreements establish a
4 conjunctive use program that facilitates the integration of the surface water and
5 groundwater supplies of the seven local irrigation districts and mutual water
6 companies that YCWA serves in Yuba County. Integration of surface water and
7 groundwater allows YCWA to increase the efficiency of its water management.

8 Under the Water Purchase Agreement, DWR administers the water transfer
9 activities. The Water Transfer Agreement allows DWR to purchase water from
10 YCWA to generally offset water costs resulting from export restrictions in winter
11 and spring each year to benefit Delta Smelt and out-migrating San Joaquin River
12 salmonids. This quantity of water is known as "Component 1 Water" under the
13 Water Purchase Agreement and is quantified as the first 60 TAF of surface water
14 above a defined baseline that Yuba releases each year. Assuming a 20 percent
15 carriage water cost, approximately 48 TAF would reach the export pumps to
16 produce a mitigation offset of approximately 48 TAF of reduced exports.

17 Additional water supplies purchased by the SWP water contractors and/or CVP
18 contractors under the Water Purchase Agreement are administered by DWR as a
19 water transfer program in drier years. These supplies include: (a) Component 2
20 water (15 TAF per year [TAF/yr] in Dry Years and up to 30 TAF/yr in Critical
21 Years); (b) Component 3 water (up to 40 TAF/yr in specified lower SWP or CVP
22 allocation years); and (c) Component 4 water (additional water that YCWA
23 makes available from surface-water supplies and its groundwater substitution
24 program). The San Luis and Delta-Mendota Water Authority is a Participating
25 Contractor to provide benefits to certain of its member CVP contractors.

26 CEQA review for all of the Yuba Accord agreements (Fisheries, Water Purchase,
27 and Conjunctive Use) was completed in 2007 and these agreements were fully
28 executed between late 2007 and early 2008. SWRCB approved the instream flow
29 schedules and water transfer aspects of the Yuba River Accord, with some
30 corrections, on March 18, 2008. The Fisheries Agreement will terminate when
31 FERC issues a new long-term FERC license for the Yuba River Development
32 Project (which will be sometime after April 30, 2016 when the present license
33 expires). The Water Purchase Agreement will terminate on December 31, 2025,
34 but the amounts of water that YCWA will transfer under the agreement after
35 FERC issues a new long-term license for the Yuba River Development Project
36 will be subject to negotiation by the parties to the agreement. The Conjunctive
37 Use Agreements will terminate when the Fisheries Agreement and Water
38 Purchase Agreement terminate. It is assumed in this EIS that the existing or
39 similar agreements will be renewed by 2030.

40 **3A.6.3.2 Transfer Capacity**

41 It is expected that water transfer programs for environmental and water supply
42 augmentation will continue in some form, and that in most years (all but the
43 driest), the scope of annual water transfers of water exported through the Delta

1 will be limited by available Delta pumping capacity, and exports for transfers will
2 be limited to the months of July-September. As such, looking at an indicator of
3 available transfer capacity in those months is one way of estimating an upper
4 boundary to the effects of transfers on an annual basis.

5 The CVP and SWP may provide Delta export pumping for transfers using
6 pumping capacity at Banks and Jones pumping plants beyond that which is being
7 used to deliver Project water supply, up to the diversion capacity, consistent with
8 existing operational and regulatory restrictions.

9 The surplus capacity available for transfers varies a great deal with hydrologic
10 conditions. In general, as hydrologic conditions get wetter, surplus capacity
11 diminishes because the CVP and SWP are more fully using export pumping
12 capacity for Project supplies. The CVP's Jones Pumping Plant has little surplus
13 capacity, except in the driest hydrologic conditions. The SWP has the most
14 surplus capacity in critical and some dry years, less or sometimes none in most
15 median hydrologic conditions, and some surplus again in some above normal and
16 wet years when demands may be lower because some water users may have
17 alternative supplies.

18 The availability of water for transfer and the demand for transferred water may
19 also vary with hydrologic conditions. Accordingly, since many transfers are
20 negotiated between willing buyers and sellers under prevailing market conditions,
21 price of water also may be a factor determining how much is transferred in any
22 year. This document does not attempt to identify how much of the available and
23 useable surplus export capacity of the CVP and SWP would actually be used for
24 transfers in a particular year, but given the recent history of water transfer
25 programs and requests for individual water transfers, trends suggest a growing
26 reliance on transfers to meet dry year water demands.

27 Under both the present and future conditions, capability to export transfers would
28 often be capacity-limited, except in Critical and some Dry years. In Critical and
29 some Dry years, both Banks and Jones pumping plants would likely have surplus
30 capacity for transfers. As a result, export capacity is less likely to limit transfers
31 in these years. During such years, low Project exports and high demand for water
32 supply could make it possible to transfer significant amounts of transfer water
33 when upstream water supplies are available.

34 **3A.6.4 Proposed Exports for Transfers**

35 Although transfers may occur at any time of year, the 2008 USFWS BO and 2009
36 NMFS BO address proposed exports for transfers during only the months July
37 through September. For transfers outside those months, or in excess of the
38 maximum amounts (listed below), separate consultations would be required with
39 the USFWS and NMFS. Based on the estimates of available capacity for export
40 of transfers during July through September, and in recognition of the many other
41 possible operational contingencies and constraints that may limit actual use of that
42 capacity for transfers, as follows.

- 1 • Critical Water Year: Maximum Transfer Amount is 600 TAF
- 2 • Dry Water Year following Critical Water Year: Maximum Transfer Amount
3 is 600 TAF
- 4 • Dry Water Year following Dry Water Year: Maximum Transfer Amount is
5 600 TAF
- 6 • All Other Water Years: Maximum Transfer Amount is 360 TAF

7 **3A.7 References**

- 8 Aceituno, M. E. 1993. *The relationship between instream flow and physical*
9 *habitat availability for Chinook Salmon in the Stanislaus River*. U.S. Fish
10 and Wildlife Service. Sacramento, CA. May.
- 11 American Public Health Association, American Water Works Association, and
12 Water Environment Federation. 2005. *Standard Methods for the*
13 *Examination of Water and Wastewater*. 21st Edition. American Public
14 Health Association, Washington, DC.
- 15 California Department of Water Resources. 1994. *Summary of salinity*
16 *conditions in Suisun Marsh during water years 1984-1992*.
17 Environmental Services Office. November 23.
- 18 California Department of Water Resources. 2013. *Aquatic Pesticide Application*
19 *Plan. Water Quality Order No. 2013-0002-DWQ. Statewide General*
20 *National Discharge Pollutant Discharge Elimination System Permit for*
21 *the Discharge of Aquatic Pesticides for Aquatic Weed Control in Waters*
22 *of the United States*. October 21.
- 23 Edwards, G. W., K. A. F. Urquhart, and T. L. Tillman. 1996. *Adult salmon*
24 *migration monitoring, Suisun Marsh Salinity Control Gates, September-*
25 *November 1994. Technical Report 50*, Interagency Ecological Program
26 for the San Francisco Bay/Delta Estuary.
- 27 National Marine Fisheries Service. 2004. *Biological Opinion on the Long-Term*
28 *Central Valley Project and State Water Project Operations Criteria and*
29 *Plan*. October. Southwest Region, Long Beach, CA.
- 30 National Marine Fisheries Service. 2009. *Biological Opinion and Conference*
31 *Opinion on the Long-Term Operations of the Central Valley Project and*
32 *State Water Project. ESA Section 7 Consultation*. National Marine
33 Fisheries Service, Southwest Region, Long Beach, CA. June 4, 2009.
34 844 pp.
- 35 Stillwater Sciences. 2004. *Environmental Water Program Pilot Flow*
36 *Augmentation Project: Concept Proposal for Flow Acquisition on Lower*
37 *Clear Creek*. Prepared for CALFED Bay-Delta Program, August 2004.

- 1 State Water Resources Control Board. 2014. *San Francisco Bay/Sacramento –*
2 *San Joaquin Delta Estuary (Bay-Delta) Program*. Site accessed October
3 23, 2014.
4 http://www.waterboards.ca.gov/waterrights/water_issues/programs/bay_delta/.
5
- 6 Tillman, T. L., G. W. Edwards, and K. A. F. Urquhart. 1996. *Adult salmon*
7 *migration during the various operational phases of the Suisun Marsh*
8 *Salinity Control Gates in Montezuma Slough, August-October 1993.*
9 *Agreement to the California Department of Water Resources*, Ecological
10 Services Office by the California Department of Fish and Game,
11 Bay-Delta and Special Water Projects Division.
- 12 U.S. Army Corps of Engineers. 1987. *Water Control Manual, Folsom Dam and*
13 *Lake, American River, California*.
- 14 U.S. Department of the Interior, *Bureau of Reclamation and ESSA Technologies*
15 *Ltd.* 2008. *Evaluation of Environmental Water Program (EWP): Pilot*
16 *Re-operation of Whiskeytown Dam Central Valley Project, California*
17 *Mid-Pacific Region. Technical briefing report No. WHI-8130-IE-2008-1.*
18 100 pp. + Appendices.
- 19 Walters, C. 1997. *Challenges in adaptive management of riparian and coastal*
20 *ecosystems*. *Conservation Ecology* [online] 1(2). Available:
21 <http://www.ecologyandsociety.org/vol1/iss2/art1/#lit>>. Accessed:
22 December 20, 1013.

This page left blank intentionally.

1 **Appendix 4A**2 **Federal and State Policies and**
3 **Regulations**4 **4A.1 Federal Policies and Regulations**

5 Federal policies and regulations presented in this appendix are related to
6 requirements that affect surface water, biological, energy, agricultural, air quality,
7 and cultural resources. Federal policies and regulations that affect operations of
8 the Central Valley Project are included in Appendix 3A, No Action Alternative:
9 Central Valley Project and State Water Project Operations, and are not included in
10 this appendix.

11 **4A.1.1 Clean Water Act**

12 The Federal Water Pollution Control Act Amendments of 1972, also known as the
13 Clean Water Act (CWA), established the institutional structure for the U.S.
14 Environmental Protection Agency (USEPA) to regulate discharges of pollutants
15 into the waters of the United States, establish water quality standards, conduct
16 planning studies, and provide funding for specific grant projects. The Clean
17 Water Act was further amended through the Clean Water Act of 1977 and the
18 Water Quality Act of 1987. The California State Water Resources Control Board
19 (SWRCB) has been designated by the USEPA along with the nine Regional
20 Water Quality Control Boards (RWQCBs) to develop and enforce water quality
21 objectives and implementation plans in California, as described below under
22 Section 4A.2, State Policies and Regulations.

23 Section 401 of the CWA requires water discharges into navigable waters of the
24 United States to apply for a Federal license or permit and to certify that the
25 discharge will be in compliance with specified provisions of the CWA. Federal
26 permits that are issued related to disturbance of waters of the United States (such
27 as streams and wetlands) also require a Water Quality Certification in accordance
28 with CWA Section 401. In California, Section 401 water quality certifications are
29 issued by the RWQCB and/or the SWRCB, in accordance with the California
30 Code of Regulations Title 23, sections 3836, 3855, and 3856.

31 Section 402 established the National Pollutant Discharge Elimination System
32 (NPDES) permit program to regulate point-source and nonpoint-source discharges
33 of pollutants into waters of the United States. An NPDES permit sets specific
34 discharge limits for point and nonpoint sources discharging pollutants into waters
35 of the United States and establishes monitoring and reporting requirements. The
36 NPDES permits are issued for long-term discharges, including discharges from
37 treatment plants, and temporary discharges, such as discharges during
38 construction activities (e.g., General Permit for Storm Water Discharges
39 Associated with Construction Activities).

1 Section 404 requires the U.S. Army Corps of Engineers (USACE) to issue permits
2 for discharge of dredge or fill material into navigable waters, their tributaries, and
3 associated wetlands. Activities regulated by 404 permits include, but are not
4 limited to, dredging, bridge construction, flood control actions, and some fishing
5 operations.

6 Section 303 requires preparation of basin plans that designate the beneficial uses
7 of waters within each watershed basin and identify water quality objectives
8 designed to protect the beneficial uses. Under Section 303(d), the USEPA
9 identifies and ranks waterbodies for which existing pollution controls are
10 insufficient to attain or maintain water quality standards based upon information
11 prepared by all states, territories, and authorized Indian tribes. This list of
12 impaired waters for each state comprises the state's 303(d) list. Each state must
13 establish priority rankings and develop Total Maximum Daily Loads (TMDLs)
14 for all impaired waters. TMDLs calculate the greatest pollutant load that a
15 waterbody can receive and still meet water quality standards and designated
16 beneficial uses.

17 The National Toxics Rule was established by USEPA in 1992 to provide ambient
18 water quality criteria for priority toxic pollutants to protect aquatic life and human
19 health in accordance with CWA Section 303.

20 The Secretary of the Interior established the first antidegradation policy in 1968.
21 In 1975, USEPA included the antidegradation requirements in the Water Quality
22 Standards Regulation (40 Code of Federal Regulations [CFR] 130.17, 40 CFR
23 55340-41). The requirements were included in the 1987 CWA amendment in
24 Section 303(d)(4)(B). The Federal antidegradation policy requires states to
25 develop regulations to allow increases in pollutant loadings or changes in surface
26 water quality only if: (1) existing surface water uses are maintained and protected,
27 and established water quality requirements are met; (2) if water quality
28 requirements cannot be maintained by a project, water quality must be maintained
29 to fully protect "fishable/swimmable" uses and other existing uses; and (3) for
30 Outstanding National Resource Waters water quality criteria where "States may
31 allow some limited activities which result in temporary and short-term changes in
32 water quality" (Water Quality Standards Regulations) but would not impact
33 existing uses or special use of these waters.

34 **4A.1.2 Federal Safe Drinking Water Act**

35 The Safe Drinking Water Act (SDWA) was originally passed by Congress in
36 1974 to protect public health by regulating the nation's public drinking water
37 supply. The SDWA authorizes USEPA to set national health-based standards for
38 drinking water to protect against both naturally occurring and human-made
39 contaminants that may be found in drinking water. The law was amended in 1986
40 and 1996, and requires many actions to protect drinking water and its sources,
41 including rivers, lakes, reservoirs, springs, and groundwater wells.

4A.1.3 U.S. Army Corps of Engineers Public Notice 5820A

Section 10 of the Rivers and Harbors Act of 1899 requires that a letter of permission or permit be obtained from the USACE for the construction of structures in, over, or under; excavation of material from; and deposition of material into navigable waters of the United States regulated by USACE. “Navigable waters of the United States” is defined as those waters subject to the ebb and flow of the tide shoreward to the mean high-water mark or those that are used, have been used in the past, or may be susceptible to use in interstate or foreign commerce.

4A.1.4 Fish and Wildlife Coordination Act

The Fish and Wildlife Coordination Act, as amended in 1964, was enacted to protect fish and wildlife when Federal actions result in the control or modification of a natural stream or body of water. The statute requires Federal agencies to take into consideration the effect that water-related projects would have on fish and wildlife resources. Consultation and coordination with the U.S. Fish and Wildlife Service (USFWS) and state fish and game agencies are required to address ways to prevent loss of and damage to fish and wildlife resources and to further develop and improve these resources.

4A.1.5 Endangered Species Act

The Federal Endangered Species Act (ESA) applies to proposed Federal, state, and local projects that may result in the “take” of a fish or wildlife species that is federally listed as threatened or endangered and to actions that are proposed to be authorized, funded, or undertaken by a Federal agency and that may jeopardize the continued existence of any federally listed fish, wildlife, or plant species or which may adversely modify or destroy designated critical habitat for such species. “Take” is defined under the ESA as “to harass, harm, pursue, hunt, shoot, wound, kill, trap, capture or collect, or to attempt to engage in any such conduct” (16 United States Code [U.S.C.] Section 1532(19)). Under Federal regulations, “harm” is defined as “an act which actually kills or injures wildlife,” including significant habitat modification or degradation where it actually results, or is reasonably expected to result, in death or injury to wildlife by substantially impairing essential behavioral patterns, including breeding, feeding, sheltering, spawning, rearing, and migrating (50 CFR sections 17.3, 222.102). “Harass” is defined similarly broadly. If there is a potential that implementing a project would result in take of a federally listed species, either a habitat conservation plan (HCP) and incidental take permit, under Section 10(a) of the ESA, or a Federal interagency consultation, under Section 7 of the ESA, is required.

Under the ESA, the National Marine Fisheries Service (NMFS) has jurisdiction over anadromous fish, marine fish and reptiles, and most marine mammals, and the USFWS has jurisdiction over all other species, including all terrestrial and plant species, freshwater fish species, and a few marine mammals (such as the California sea otter). Listed species within the project area are described in subsequent sections of this appendix.

1 Besides listing species within their respective jurisdictions as threatened or
2 endangered, issuing incidental take permits, and conducting interagency
3 consultations, USFWS and NMFS also are charged with designating “critical
4 habitat” for threatened and endangered species, which the ESA defines as
5 (1) specific areas within the geographical area occupied by the species at the time
6 of listing, if they contain physical or biological features essential to a species’
7 conservation, and those features may require special management considerations
8 or protection, and (2) specific areas outside the geographical area occupied by the
9 species if the agency determines that the area itself is essential for conservation of
10 the species (16 U.S.C. Section 1532(5)(A)). USFWS and NMFS also prepare
11 draft recovery plans for the listed species.

12 **4A.1.5.1 NMFS Public Draft Recovery Plan for the Evolutionarily**
13 **Significant Units of Sacramento River Winter-run Chinook**
14 **Salmon and Central Valley Spring-run Chinook Salmon and the**
15 **Distinct Population Segment of Central Valley Steelhead**

16 The NMFS Public Draft Recovery Plan for the Evolutionarily Significant Units of
17 Sacramento River Winter-run Chinook Salmon and Central Valley Spring-run
18 Chinook Salmon and the Distinct Population Segment of Central Valley Steelhead
19 provides a roadmap that describes the steps, strategy, and actions recommended to
20 return winter-run Chinook Salmon, spring-run Chinook Salmon, and Steelhead to
21 viable status in the Central Valley, thereby ensuring their long-term persistence
22 and evolutionary potential. The general near-term strategic approach to recovery
23 includes the following elements:

- 24 • Secure all extant populations.
- 25 • Begin collecting distribution and abundance data for Steelhead in habitats
26 accessible to anadromous fish.
- 27 • Minimize straying from hatcheries to natural spawning areas.
- 28 • Conduct critical research on fish passage above rim dams, reintroductions, and
29 climate change.

30 The long-term approach to recovery includes the following elements:

- 31 • Ensure that every extant diversity group has a high probability of persistence.
- 32 • Until all evolutionarily significant unit viability criteria have been achieved,
33 no population should be allowed to deteriorate in its probability of persistence.
- 34 • High levels of recovery should be attempted in more populations than
35 identified in the diversity group viability criteria because not all attempts will
36 be successful.
- 37 • Individual populations within a diversity group should have persistence
38 probabilities consistent with a high probability of diversity group persistence.
- 39 • Within a diversity group, the populations to be restored/maintained at viable
40 status should be selected.

- 1 • Allow for normative metapopulation processes, including the viability of core
- 2 populations, which are defined as the most productive populations.
- 3 • Allow for normative evolutionary processes, including the retention of genetic
- 4 diversity and an increase in genetic diversity through the addition of viable
- 5 populations in historical habitats.
- 6 • Minimize susceptibility to catastrophic events.

7 **4A.1.5.2 USFWS Recovery Plan for the Sacramento-San Joaquin Delta**
 8 **Native Fishes**

9 The Recovery Plan for the Sacramento-San Joaquin Delta Native Fishes, released
 10 in 1996, addresses the recovery needs for several fishes that occupy the
 11 Sacramento-San Joaquin Delta, including Delta Smelt, Sacramento Splittail,
 12 Longfin Smelt, Green Sturgeon, Chinook Salmon (spring-run, late fall-run, and
 13 San Joaquin fall-run), and Sacramento Perch (believed to be extirpated). The
 14 objective of the plan is to establish self-sustaining populations of these species
 15 that will persist indefinitely. This objective would be accomplished by managing
 16 the estuary to provide better habitat for aquatic life in general and for the fish
 17 addressed by the plan. Recovery actions include tasks such as increasing
 18 freshwater flows; reducing fish entrainment losses to water diversions; reducing
 19 the effects of dredging, contaminants, and harvest; developing additional shallow-
 20 water habitat, riparian vegetation zones, and tidal marsh; reducing effects of toxic
 21 substances from urban nonpoint sources; reducing the effects of introduced
 22 species; and conducting research and monitoring.

23 **4A.1.6 Magnuson-Stevens Fishery Conservation and**
 24 **Management Act**

25 The Magnuson-Stevens Fishery Conservation and Management Act, as amended
 26 by the Sustainable Fisheries Act (Public Law 104 to 297), requires that all Federal
 27 agencies consult with NMFS on activities or proposed activities authorized,
 28 funded, or undertaken by that agency that may adversely affect Essential Fish
 29 Habitat (EFH) for commercially managed marine and anadromous fish species.
 30 EFH includes specifically identified waters and substrate necessary for fish
 31 spawning, breeding, feeding, or growing to maturity. EFH also includes all
 32 habitats necessary to allow the production of commercially valuable aquatic
 33 species, to support a long-term sustainable fishery, and to contribute to a healthy
 34 ecosystem (16 U.S.C. Section 1802(10)).

35 In addition to riverine reaches supporting Chinook Salmon, the Pacific Fishery
 36 Management Council (PFMC) has designated the Sacramento-San Joaquin Delta
 37 (Delta), San Francisco Bay, and Suisun Bay as EFH to protect and enhance
 38 habitat for coastal marine fish and macroinvertebrate species that support
 39 commercial fisheries such as Pacific salmon. Chinook Salmon and Coho Salmon
 40 are Actively Managed Species under the Pacific Coast Salmon Plan. Because
 41 EFH applies only to commercial fisheries, Chinook and Coho Salmon habitats are
 42 included, but not those of Steelhead.

1 Three fishery management plans—Pacific Salmon, Coastal Pelagic, and
2 Groundfish—have been issued by the PFMC for several species that occur in the
3 project area. The Northern Anchovy and Starry Flounder are identified by the
4 PFMC as Monitored Species in the Coastal Pelagic Species Fishery Management
5 Plan and the Pacific Coast Groundfish Fishery Management Plan, respectively,
6 and are subject to EFH consultation as a result. Pacific Sardine are classified as
7 an Actively Managed Species in the Coastal Pelagic Species Fishery
8 Management Plan.

9 **4A.1.7 Marine Mammal Protection Act**

10 The Marine Mammal Protection Act (MMPA) was enacted in 1972. All marine
11 mammals are protected under the MMPA. The MMPA prohibits, with certain
12 exceptions, the “take” of marine mammals in U.S. waters and by U.S. citizens on
13 the high seas, and the importation of marine mammals and marine mammal
14 products into the United States. It defines “take” to mean “to hunt harass,
15 capture, or kill” any marine mammal or attempt to do so. Exceptions to the
16 moratorium can be made through permitting actions for take incidental to
17 commercial fishing and other nonfishing activities; for scientific research; and for
18 public display at licensed institutions such as aquaria and science centers.

19 **4A.1.8 National Invasive Species Act of 1996**

20 The National Invasive Species Act (Public Law 104-332) reauthorizes and
21 amends the Nonindigenous Aquatic Nuisance Prevention and Control Act of 1990
22 to mandate regulations to reduce environmental and economic impacts from
23 invasive species and to prevent introduction and spread of aquatic nuisance
24 species, primarily through ballast water. As the primary Federal law regulating
25 ballast water discharges, the act calls primarily for voluntary ballast water
26 exchange by vessels entering the United States after operating outside the
27 200-nautical-mile Exclusive Economic Zone of the United States.

28 The authority to regulate ballast water discharges in the United States has recently
29 shifted to include the USEPA in addition to the U.S. Coast Guard. Since
30 February 2009, the USEPA must regulate ballast water and other discharges
31 incidental to normal vessel operations under Section 402 of the CWA. U.S. Coast
32 Guard regulations, developed under authority of the revised and reauthorized act,
33 also require ballast water management (i.e., ballast water exchange) for vessels
34 entering United States waters from outside the Exclusive Economic Zone, with
35 certain exceptions. The act also authorized funding for research on aquatic
36 nuisance species prevention and control in San Francisco Bay, the Delta, the
37 Pacific Coast, and other areas of the United States.

38 **4A.1.8.1 Executive Order 13112: Invasive Species**

39 Executive Order (EO) 13112 (February 3, 1999) directs all Federal agencies to
40 prevent and control the introduction and spread of invasive nonnative species in a
41 cost-effective and environmentally sound manner to minimize their effects on
42 economic, ecological, and human health. The executive order was intended to
43 build on existing laws, such as National Environmental Policy Act (NEPA), the

1 Nonindigenous Aquatic Nuisance Prevention and Control Act, the Lacey Act, the
2 Plant Pest Act, the Federal Noxious Weed Act, and the ESA. EO 13112
3 established a national Invasive Species Council made up of Federal agencies and
4 departments, and a supporting Invasive Species Advisory Committee composed
5 of state, local, and private entities. The Invasive Species Council and Advisory
6 Committee oversee and facilitate implementation of the executive order, including
7 preparation and revision of the National Invasive Species Management Plan.

8 **4A.1.9 Wild and Scenic Rivers Act**

9 Congress created the National Wild and Scenic Rivers Act in 1968 (Public Law
10 90-542; U.S.C. 1271 et seq.) to preserve rivers and outstanding natural, cultural,
11 or recreational features in a free-flowing condition. High priority is placed on
12 visual resource management of these rivers to preserve or restore their scenic
13 characteristics. Under this act, a Federal agency may not assist the construction
14 of a water resources project that would have a direct and adverse effect on the
15 free-flowing, scenic, and natural values of a wild or scenic river. If the project
16 would affect the free-flowing characteristics of a designated river or unreasonably
17 diminish the scenic, recreational, and fish and wildlife values present in the area,
18 such activities should be undertaken in a manner that would minimize adverse
19 impacts and should be developed in consultation with the National Park Service.

20 **4A.1.10 Migratory Bird Treaty Act**

21 The Migratory Bird Treaty Act (MBTA) implements a series of international
22 treaties that provide migratory bird protection. The MBTA authorizes the
23 Secretary of the Interior to regulate the taking of migratory birds, and the act
24 provides that it shall be unlawful, except as permitted by regulations, “to pursue,
25 take, or kill any migratory bird, or any part, nest or egg of any such bird” (16
26 U.S.C. Section 703). This prohibition includes both direct and indirect acts,
27 although harassment and habitat modification are not included unless they result
28 in direct loss of birds, nests, or eggs. The current list of species protected by the
29 MBTA was published in the March 10, 2010, *Federal Register* (*Federal Register*,
30 Volume 75, page 9282 [75 FR 9282]).

31 **4A.1.10.1 Executive Order 13186: Responsibilities of Federal Agencies to** 32 **Protect Migratory Birds**

33 EO 13186 (January 10, 2001) directs Federal agencies that have, or are likely to
34 have, a measurable negative effect on migratory bird populations to develop and
35 implement a memorandum of understanding with USFWS to promote the
36 conservation of migratory bird populations. The memorandum of understanding
37 should include implementation actions and reporting procedures that would be
38 followed through each agency’s formal planning process, such as resource
39 management plans and fisheries management plans.

40 **4A.1.10.2 North American Waterfowl Management Plan and Central Valley** 41 **Joint Venture**

42 In 1986, the North American Waterfowl Management Plan (NAWMP) was
43 signed by the United States and Canada. It provides a broad framework for

1 waterfowl management through 2000 and includes recommendations for wetland
2 and upland habitat protection, restoration, and enhancement. Implementing the
3 NAWMP is the responsibility of designated joint ventures. The Central Valley
4 Habitat Joint Venture, formally organized in 1988, was one of the original six
5 priority joint ventures formed under the NAWMP. Renamed the Central Valley
6 Joint Venture in 2004, it is composed of 21 Federal and state agencies,
7 conservation organizations, and Pacific Gas and Electric Company (PG&E).

8 **4A.1.11 Executive Order 11990: Protection of Wetlands**

9 EO 11990 (May 24, 1977) established the protection of wetlands and riparian
10 systems as the official policy of the Federal government. It requires all Federal
11 agencies to consider wetland protection as an important part of their policies and
12 take action to minimize the destruction, loss, or degradation of wetlands and to
13 preserve and enhance the natural and beneficial values of wetlands.

14 **4A.1.12 Federal Power Act**

15 The Federal Power Act, 16 U.S.C. § 791-828(c), passed in 1920 and amended in
16 1935 and 1986, created what is now the Federal Energy Regulatory Commission
17 (FERC), an independent regulatory agency that oversees the natural gas, oil, and
18 electricity markets, regulates the transmission and sale of these energy resources
19 (except for oil), provides licenses for non-federal hydroelectric plants, and
20 addresses environmental matters arising in any of the areas above. The agency is
21 governed by a five-member commission appointed by the President with the
22 advice and consent of the Senate. The Electric Consumers Protection Act of 1986
23 amended the Federal Power Act of 1920 to require FERC to give equal
24 consideration to non-power-generating values such as the environment,
25 recreation, fish, and wildlife, as is given to power and development objectives
26 when making hydroelectric project licensing decisions.

27 **4A.1.13 Western Area Power Administration**

28 The Western Area Power Administration (Western) is one of four power
29 marketing administrations within the U.S. Department of Energy that markets and
30 transmits electricity from multi-use water projects to retail power distribution
31 companies and public authorities. Western markets and delivers hydroelectric
32 power and related services within a 15-state region of the central and western
33 United States. The transmission system carries electricity from 55 hydropower
34 plants operated by Reclamation, USACE, and the International Boundary and
35 Water Commission. Together, these plants have a capacity of 10,600 megawatts.

36 Western sells excess Central Valley Project (CVP) capacity and energy that are
37 supplementary to CVP internal needs to municipal utilities, irrigation districts,
38 and institutions and facilities such as wildlife refuges, schools, prisons, and
39 military bases at rates designed to recover CVP costs. As part of its marketing
40 function, Western ensures that CVP project use loads are met at all times by using
41 a mix of generation resources including CVP generation and other purchased
42 resources. In marketing power surplus to the CVP project needs, Western follows
43 a formal procedure for allocating CVP energy to preference customers.

1 Preference power customers have 20-year contracts for their share of the CVP
2 energy that is in excess of CVP needs.

3 In addition to preference power customers, there are also first preference
4 customers. First preference customers are a special class of customers who are
5 statutorily entitled to up to 25 percent of the generation built in their counties.
6 The two CVP projects whose enabling legislation provided for first preference
7 power are New Melones Dam, located in Tuolumne and Calaveras counties, and
8 Trinity and Lewiston dams, located in Trinity County.

9 **4A.1.14 Farmland Protection Policy Act**

10 The Farmland Protection Policy Act (FPPA) directs Federal agencies to consider
11 the effects of Federal programs or activities on farmland, and ensure that such
12 programs, to the extent practicable, are compatible with state, local, and private
13 farmland protection programs and policies. The FPPA is intended to minimize
14 the impact Federal programs have on the unnecessary and irreversible conversion
15 of farmland to nonagricultural uses. It assures that, to the extent possible, Federal
16 programs are administered to be compatible with state, local units of government,
17 and private programs and policies to protect farmland. Projects are subject to
18 FPPA requirements if they may irreversibly convert farmland (directly or
19 indirectly) to nonagricultural use and are completed by a Federal agency or with
20 assistance from a Federal agency. Activities that may be subject to the FPPA
21 include (among others) reservoir and hydroelectric projects, Federal agency
22 projects that convert farmland, and other projects completed with Federal
23 assistance. The U.S. Department of Agriculture (USDA) Natural Resources
24 Conservation Service (NRCS) implements the FPPA. The NRCS has established
25 a rating process under the FPPA to assess options for land use on an evaluation of
26 productivity weighed against commitment to urban development.

27 **4A.1.15 Coastal Zone Management Act**

28 Congress passed the Coastal Zone Management Act (CZMA) in 1972 in response
29 to the challenges of growth in coastal areas of the United States. The act is
30 intended to “preserve, protect, develop, and where possible, to restore or enhance
31 the resources of the nation’s coastal zone.” The CZMA is administered by the
32 National Oceanic and Atmospheric Administration’s Office of Ocean and Coastal
33 Resource Management (OCRM), and provides incentives for states to manage and
34 protect their coastal resources. The CZMA encourages states to prepare coastal
35 zone management programs that meet specified requirements and submit them to
36 the OCRM for approval. States with approved coastal management programs
37 become eligible for Federal funding assistance and other benefits. Applicants for
38 Federal permits and licenses and Federal agencies proposing specific activities in
39 the coastal zone are required by the CZMA to obtain a consistency certification
40 from the state’s coastal management agency.

41 The California Coastal Commission is the lead agency for the Coastal Zone
42 Management Program in California. In California, the Coastal Zone Management
43 Program includes the Pacific Ocean coast and the area within San Francisco Bay

1 and Suisun Marsh under the jurisdiction of the San Francisco Bay Conservation
2 and Development Commission.

3 **4A.1.16 Federal Water Project Recreation Act**

4 The Federal Water Project Recreation Act (16 U.S.C. sections 460(L)(12)–
5 460(L)(21)) declares the intent of Congress that recreation and fish and wildlife
6 enhancement be given full consideration as purposes of Federal water
7 development projects if non-federal public bodies agree to: (1) bear not less than
8 one-half the separable costs allocated for recreational purposes or 25 percent of
9 the cost for fish and wildlife enhancement; (2) administer project land and water
10 areas devoted to these purposes; and (3) bear all costs of operation, maintenance
11 and replacement. Where Federal lands or authorized Federal programs for fish
12 and wildlife conservation are involved, cost-sharing is not required.

13 This act also authorizes the use of Federal water project funds for land acquisition
14 in order to establish refuges for migratory waterfowl when recommended by the
15 Secretary of the Interior, and authorizes the Secretary to provide facilities for
16 outdoor recreation and fish and wildlife at all reservoirs under Department of the
17 Interior (DOI) control, except those within national wildlife refuges.

18 **4A.1.17 Federal Land and Water Conservation Fund Act**

19 The Land and Water Conservation Fund was established by Congress in 1964 and
20 is administered by the National Park Service. The fund provides money to
21 Federal, state, and local agencies as well as to six territories to purchase lands,
22 waters, and wetlands for the benefit of all Americans. Lands and waters
23 purchased through the Land and Water Conservation Fund are used to:

- 24 • Provide recreational opportunities
- 25 • Provide clean water
- 26 • Preserve wildlife habitat
- 27 • Enhance scenic vistas
- 28 • Protect archaeological and historical sites
- 29 • Maintain the pristine nature of wilderness areas

30 **4A.1.18 Bureau of Land Management Resource Management Plans**

31 Under the Federal Land Policy and Management Act of 1976, DOI Bureau of
32 Land Management (BLM) is responsible for managing public lands for multiple
33 uses and sustained yield, ensuring that the scenic values of these public lands are
34 considered, and avoiding land uses that may have negative impacts. Resource
35 management plans for public lands are developed to guide BLM actions to protect
36 ecological and scientific values; preserve public lands in their natural condition,
37 where appropriate; provide food and habitat for fish and wildlife and domestic
38 animals; provide for outdoor recreation and human occupancy and use; and
39 recognize the nation's need for natural resources from the public lands, such as
40 minerals, food, timber, and fiber.

1 **4A.1.19 Federal Clean Air Act**

2 National air quality policies are regulated through the Federal Clean Air Act
3 (CAA) of 1970 and its 1977 and 1990 amendments. Basic elements of the CAA
4 include national ambient air quality standards (NAAQS) for criteria air pollutants,
5 hazardous air pollutants standards, state attainment plans, motor vehicle emissions
6 standards, stationary source emissions standards and permits, acid rain control
7 measures, stratospheric ozone protection, and enforcement provisions.

8 **4A.1.19.1 National Ambient Air Quality Standards and Federal Air** 9 **Quality Designations**

10 Pursuant to the CAA, the USEPA establishes NAAQS for ozone (O₃), carbon
11 monoxide (CO), nitrogen dioxide (NO₂), sulfur oxides (SO_x), particulate matter
12 less than 10 microns in aerodynamic diameter (PM₁₀), particulate matter less than
13 2.5 microns in aerodynamic diameter (PM_{2.5}), and lead (Pb). These pollutants are
14 referred to as criteria pollutants because numerical health-based criteria have been
15 established that define acceptable levels of exposure for each pollutant.

16 The USEPA has revised the NAAQS several times since their original
17 implementation and will continue to do so as the health effects of exposure to
18 pollution are better understood. As new NAAQS are adopted, ambient air quality
19 monitoring data are reviewed by the regulatory agencies for each geographic area,
20 and the USEPA uses the findings to designate the area's pollutant-specific
21 attainment status.

22 The USEPA designates areas as attainment, nonattainment, or unclassified for
23 individual criteria pollutants depending on whether the area achieves (i.e., attains)
24 the applicable NAAQS for each pollutant. An area can be designated as
25 attainment for one pollutant (for example, NO₂) and nonattainment for others
26 (for example, O₃ and PM₁₀). Areas that lack monitoring data are designated as
27 unclassified areas. Unclassified areas are treated as attainment areas for
28 regulatory purposes.

29 For some pollutants, there are numerous classifications of the nonattainment
30 designation, depending on the severity of an area's nonattainment status. For
31 example, the O₃ nonattainment designation has eight subclasses: basic,
32 transitional, marginal, moderate, serious, severe 15, severe 17, and extreme.

33 Under the 1977 CAA amendments, states (or areas within states) with ambient air
34 quality concentrations that do not meet the NAAQS are required to develop and
35 maintain state implementation plans (SIPs). These plans constitute a federally
36 enforceable definition of the state's approach and schedule for the attainment of
37 the NAAQS.

38 Areas that were designated as nonattainment in the past but have since achieved
39 the NAAQS are further classified as attainment maintenance areas. The
40 maintenance classification remains in effect for 20 years from the date when the
41 area is determined by the USEPA to meet the NAAQS. States must obtain
42 USEPA approval of maintenance plans to ensure continued attainment over these
43 20-year time frames.

1 **4A.1.19.2 Federal General Conformity Requirements**

2 The 1977 CAA amendments state that the Federal government is prohibited from
3 engaging in, supporting, providing financial assistance for, licensing, permitting,
4 or approving any activity that does not conform to an applicable SIP. In the 1990
5 CAA amendments, the USEPA included provisions requiring Federal agencies to
6 ensure that actions undertaken in nonattainment or attainment maintenance areas
7 are consistent with applicable SIPs. The process of determining whether a
8 Federal action is consistent with applicable SIPs is called “conformity”
9 determination.

10 These conformity provisions were put in place to ensure that Federal agencies
11 would contribute to and not undermine efforts to attain the NAAQS. The USEPA
12 has issued two conformity regulations: (1) a transportation conformity regulation
13 that applies to transportation plans, programs, and projects and (2) a general
14 conformity regulation that applies to all other Federal actions. A conformity
15 determination is a process that demonstrates how an action would conform to the
16 applicable SIP, and is required only for the project alternative that is ultimately
17 selected and approved. If a project’s emissions cannot be reduced sufficiently and
18 if air dispersion modeling cannot demonstrate conformity, then either a plan for
19 mitigating or a plan for offsetting the emissions would need to be developed. The
20 general conformity determination is submitted in the form of a written finding that
21 is issued after a minimum 30-day public comment period on the draft
22 determination.

23 The USEPA general conformity regulation applies only to Federal actions that
24 result in emissions of “nonattainment or maintenance pollutants” or their
25 precursors in federally designated nonattainment or maintenance areas. The
26 general conformity regulation establishes a process to demonstrate that Federal
27 actions would be consistent with applicable SIPs and would not cause or
28 contribute to new violations of the NAAQS, increase the frequency or severity of
29 existing violations of the NAAQS, or delay the timely attainment of the NAAQS.
30 The emission thresholds that trigger requirements of the general conformity
31 regulation for Federal actions emitting nonattainment or maintenance pollutants,
32 or their precursors, are called *de minimis* levels.

33 **4A.1.19.3 Prevention of Significant Deterioration/New Source Review and**
34 **New Source Performance Standards**

35 The CAA and amendments also include regulations intended to prevent
36 significant deterioration of air quality in attainment or maintenance areas, to
37 provide for New Source Review (NSR) of major sources and modifications in
38 nonattainment areas, and to establish emission performance standards for new
39 stationary sources or New Source Performance Standards (NSPS). Federal
40 Prevention of Significant Deterioration (PSD)/NSR regulations apply to major
41 stationary sources of emissions in attainment and maintenance areas. NSPS apply
42 to various types of new, modified, or reconstructed emissions units, and apply to
43 such units regardless of whether these units are located at facilities that are
44 “major” sources of emissions for PSD/NSR purposes.

1 **4A.1.19.4 Federal Regulations for Hazardous Air Pollutants**

2 Hazardous air pollutants (HAPs) are defined as air pollutants that may cause
3 serious human health effects, including mortality, but which are not regulated
4 through issuance of a national ambient air quality standard.

5 The USEPA has developed regulations to evaluate and, if necessary, mitigate
6 HAPs emissions sources. Prior to the 1990 CAA amendments, the USEPA
7 established pollutant-specific National Emission Standards for Hazardous Air
8 Pollutants (NESHAPs). NESHAPs were established for benzene, vinyl chloride,
9 radionuclides, mercury, asbestos, beryllium, inorganic arsenic, radon 222, and
10 coke oven emissions. The 1990 CAA amendments list 189 total pollutants that
11 are defined as HAPs. For this list of pollutants, the USEPA is required to set
12 standards for categories and subcategories of sources that emit HAPs, rather than
13 for the pollutants themselves. USEPA began issuing the new standards, referred
14 to as Maximum Achievable Control Technology (MACT) standards, in November
15 1994. NESHAPs set before 1991 remain applicable.

16 The applicability of MACT standards is typically determined by each facility's
17 Potential To Emit (PTE) HAPs from all applicable sources. The facility-wide
18 PTE HAP applicability threshold values are 10 tons per year (tpy) for a single
19 HAP and 25 tpy for any two or more HAPs.

20 **4A.1.19.5 Federal Standards for Mobile Sources**

21 The USEPA's Office of Transportation and Air Quality regulates air pollution
22 from motor vehicles and engines and the fuels used to operate them. The USEPA
23 defines "mobile sources" to include cars, light-duty trucks, heavy-duty trucks,
24 buses, recreational vehicles (such as dirt bikes and snowmobiles), farm and
25 construction machines, lawn and garden equipment, marine engines, aircraft, and
26 locomotives.

27 Starting in the 1970s, the USEPA has established progressively more stringent
28 standards for CO, hydrocarbons, nitrogen oxides (NO_x), and particulate matter
29 (PM) emissions from on-road vehicles. Since the early 1990s, USEPA has
30 developed similar standards for non-road engines and equipment, and also set
31 tighter limits on sulfur allowed in fuels used for mobile sources. Emission
32 standards set limits on the amount of pollution a vehicle or engine can emit, and
33 are designed to force future vehicles and engines to meet stricter standards.

34 **4A.1.20 Federal Policies and Regulations for Greenhouse
35 Gas Emissions**

36 Currently, no Federal regulations or standards specifically regulate greenhouse
37 gas (GHG) emissions for the purposes of addressing climate change. The Council
38 on Environmental Quality (CEQ) has issued draft NEPA guidance on GHG and
39 climate change. USEPA, through the CAA, regulates emissions of certain GHGs
40 through its mobile source standards and stationary source permitting regulations.
41 The U.S. Supreme Court in *Massachusetts v. USEPA* (Supreme Court Case
42 05-1120) found that USEPA has the authority to list GHGs as pollutants and to
43 regulate emissions of GHGs under the CAA.

1 **4A.1.20.1 CEQ Guidance Related to Greenhouse Gas Emissions**

2 The CEQ has issued updated draft NEPA guidance on the consideration of the
3 effects of climate change and GHG emissions. Issued on December 18, 2014, this
4 guidance advises Federal agencies that they should consider the GHG emissions
5 caused by Federal actions, adapt their actions to consider climate change effects
6 throughout the process, and address these issues in their agency procedures.
7 Where applicable, the scope of the NEPA analysis should cover the GHG
8 emissions effects of a proposed action and alternative actions, as well as the
9 relationship of climate change effects, on a proposed action or alternatives. The
10 CEQ guidance is still considered draft as of the writing of this document and is
11 not an official CEQ policy document.

12 **4A.1.20.2 Mandatory Greenhouse Gas Reporting Rule**

13 On September 22, 2009, USEPA released its final Greenhouse Gas Reporting
14 Rule (Reporting Rule). The Reporting Rule applies to most entities that emit
15 25,000 metric tpy of carbon dioxide equivalents (CO₂e) or more. Starting in
16 2010, owners of facilities of sufficient size were required to submit an annual
17 GHG emissions report with detailed calculations of GHG emissions from
18 specified sources, such as stationary source fuel combustion. The Reporting Rule
19 mandates recordkeeping, and administrative requirements allow USEPA to verify
20 the annual GHG emissions reports.

21 **4A.1.20.3 Environmental Protection Agency Endangerment and Cause and**
22 **Contribute Findings**

23 On December 7, 2009, the USEPA Administrator signed two distinct findings
24 regarding GHGs under Section 202(a) of the CAA:

- 25 • **Endangerment Finding:** The Administrator found that the current and
26 projected atmospheric concentrations of six key GHGs (carbon dioxide,
27 methane, nitrous oxide, hydrofluorocarbons, perfluorocarbons, and sulfur
28 hexafluoride) threaten the public health and welfare of current and future
29 generations.
- 30 • **Cause or Contribute Finding:** The Administrator found that the combined
31 emissions of GHGs from new motor vehicles and new motor vehicle engines
32 contribute to GHG pollution, which threatens public health and welfare.

33 In addition, USEPA has formally recognized climate change as a threat to water
34 supply in their National Water Program strategy for response to climate change.

35 **4A.1.20.4 Greenhouse Gas Tailoring Rule**

36 On May 13, 2010, the USEPA issued the Tailoring Rule to address GHG
37 emissions from stationary sources under the CAA permitting programs for major
38 sources. This final rule set the thresholds for Steps 1 and 2 of a phase-in approach
39 to regulating GHG emissions under the PSD/NSR and Title V Operating Permit
40 programs. Neither of these major source permitting programs is applicable to the
41 Transfer Project or the Proposed Project or any of the alternatives.

1 **4A.1.20.4.1 Light-Duty Vehicle Greenhouse Gas Emission Standards and**
 2 **Fuel Economy Standards**

3 On May 7, 2010, the USEPA and the National Highway and Traffic Safety
 4 Administration issued a joint final rule for Light-Duty Vehicle GHG Emission
 5 Standards and Corporate Average Fuel Economy Standards. The standards have
 6 been developed to reduce GHG emissions from mobile sources and improve
 7 fuel economy.

8 **4A.1.21 Antiquities Act of 1906**

9 The Antiquities Act of 1906 (16 U.S.C. sections 431–433) was the first Federal
 10 legislation promulgated to protect cultural resources on Federal lands. The act
 11 establishes a permit program for qualified institutions and provides fines or
 12 imprisonment for unpermitted persons convicted of appropriating, excavating,
 13 injuring, or destroying historic or prehistoric resources or objects of antiquity on
 14 lands controlled or managed by the Federal government.

15 **4A.1.22 The Archaeological Resources Protection Act of 1979**

16 The Archaeological Resources Protection Act of 1979 (16 U.S.C. sections
 17 470aa-470mm) was adopted to strengthen the enforcement and penalties of the
 18 Antiquities Act. It regulates and permits the excavation of archaeological sites
 19 on Federal and Indian lands, and governs the removal and management of
 20 archaeological collections from these sites. It allows for enforcement of criminal
 21 and civil penalties against those who loot, vandalize, or illegally buy or sell
 22 archaeological resources (defined as items of at least 100 years of age).

23 **4A.1.23 National Historic Preservation Act of 1966**

24 Section 106 of the National Historic Preservation Act of 1966 (NHPA) and its
 25 implementing regulations (36 CFR Part 800) require Federal agencies to consider
 26 the effects of their undertakings on cultural resources that are, or that may be,
 27 eligible for listing in the National Register of Historic Places (NRHP) and to
 28 afford the Advisory Council on Historic Preservation an opportunity to comment.
 29 NRHP-eligible resources are considered to be “significant.” The criteria used to
 30 evaluate eligibility for listing in the NRHP are further discussed in the next
 31 subsection.

32 The Section 106 process that is typically associated with NEPA compliance
 33 requires consultation of the Federal lead agency with other Federal, state, and
 34 local agencies, the Advisory Council on Historic Preservation, the State Historic
 35 Preservation Officer, Indian tribes, and interested members of the public, such as
 36 historical societies. Throughout the Section 106 process, the Federal lead agency
 37 and consulting parties work together to identify adverse impacts on sites of
 38 cultural significance or historic properties, and seek ways to avoid, minimize, or
 39 mitigate the adverse effects. A Memorandum of Agreement or Programmatic
 40 Agreement is issued by the participating parties that includes the measures agreed
 41 upon to avoid or reduce (i.e., mitigate) adverse effects. For large or complex
 42 undertakings, a Programmatic Agreement may also be negotiated to develop a
 43 phased approach to historic properties management or alternative Section 106

1 processes through consultations. Thus, impacts to cultural resources that are
2 identified in a NEPA document are addressed through Section 106.

3 Section 110 of the NHPA sets out the broad responsibilities of Federal agencies
4 for identifying and protecting historic properties under their jurisdiction, and for
5 avoiding unnecessary damage to them. It is intended to ensure that an historic
6 preservation program is fully integrated into the ongoing program of each Federal
7 agency. Section 110 allows the costs of preservation activities as eligible project
8 costs in all undertakings conducted or assisted by a Federal agency. Federal
9 agencies are directed to withhold grants, licenses, approvals, or other assistance to
10 applicants who intentionally damage or adversely affect historic properties in an
11 effort to avoid the Section 106 process.

12 **4A.1.24 National Register of Historic Places**

13 The NRHP was authorized under the NHPA to identify, evaluate, and protect
14 historic and archaeological resources. The National Park Service, under the
15 Secretary of the Interior, administers the NRHP through the consultation and
16 review functions of the Advisory Council on Historic Preservation. Properties
17 listed in the NRHP include districts, sites, buildings, structures, and objects that
18 are significant to American history, architecture, archaeology, engineering, and
19 culture. These resources contribute to an understanding of the historical and
20 cultural foundations of the nation. The NRHP eligibility criteria are presented in
21 36 CFR Section 60.4.

22 **4A.1.25 American Indian Religious Freedom Act**

23 The American Indian Religious Freedom Act of 1978 protects the rights of Native
24 Americans to freedom of expression of traditional religions (24 U.S.C. Section
25 1996). This act established “the policy of the United States to protect and
26 preserve for American Indians their inherent right of freedom to believe, express,
27 and exercise the traditional religions... including but not limited to access to sites,
28 use and possession of sacred objects, and the freedom to worship through
29 ceremonials and traditional rites.”

30 **4A.1.26 Native American Graves Protection and Repatriation Act**

31 The Native American Graves Protection and Repatriation Act provides a
32 systematic process for determining the rights of lineal descendants and recognized
33 Indian tribes and Native Hawaiian organizations to claim and recover Native
34 American human remains, funerary objects, sacred objects, and objects of cultural
35 patrimony. Native American descendants, tribes, and organizations are to be
36 consulted when such items are inadvertently discovered or intentionally excavated
37 on Federal or tribal lands. Regulations in 43 CFR Part 10, Section 10.4, outline
38 requirements for notification of inadvertent discoveries, ceasing activity,
39 consultation, disposition of the items, and resumption of activity. The act also
40 covers claims and recovery of Native American human remains and burial
41 artifacts held by the Federal government or federally funded museums.

4A.1.27 Indian Trust Asset Policies

Indian trust assets (ITAs) are legal interests in property held in trust by the U.S. Government for federally-recognized Indian tribes or individual Indians. An Indian trust has three components: (1) the trustee, (2) the beneficiary, and (3) the trust asset. ITAs can include land, minerals, federally-reserved hunting and fishing rights, federally-reserved water rights, and in-stream flows associated with trust land. Beneficiaries of the Indian trust relationship are federally-recognized Indian tribes with trust land; the U.S. is the trustee. By definition, ITAs cannot be sold, leased, or otherwise encumbered without approval of the U.S. The characterization and application of the U.S. trust relationship have been defined by case law that interprets Congressional acts, executive orders, and historical treaty provisions.

The Federal government, through treaty, statute, or regulation, may take on specific, enforceable fiduciary obligations that give rise to a trust responsibility to federally-recognized tribes and individual Indians possessing trust assets. Courts have recognized an enforceable Federal fiduciary duty with respect to Federal supervision of Indian money or natural resources, held in trust by the Federal government, where specific treaties, statutes or regulations create such a fiduciary duty.

Consistent with President William J. Clinton’s 1994 memorandum, “Government-to-Government Relations with Native American Tribal Governments,” Bureau of Reclamation (Reclamation) assesses the effect of its programs on tribal trust resources and federally-recognized tribal governments. Reclamation is tasked to actively engage federally-recognized tribal governments and consult with such tribes on government-to-government level when its actions affect ITAs (*Federal Register*, Vol. 59, No. 85, May 4, 1994, pages 22951–22952). The DOI Departmental Manual Part 512.2 ascribes the responsibility for ensuring protection of ITAs to the heads of bureaus and offices. DOI is required to carry out activities in a manner that protects ITAs and avoids adverse effects whenever possible.

4A.1.28 Indian Sacred Sites on Federal Land

EO 13007 provides that in managing Federal lands, each Federal agency with statutory or administrative responsibility for management of Federal lands shall, to the extent practicable and as permitted by law, accommodate access to and ceremonial use of Indian sacred sites by Indian religious practitioners, and avoid adversely affecting the physical integrity of such sacred sites.

4A.1.29 Federal Policies and Regulations Related to Environmental Justice**4A.1.29.1 Executive Order 12898**

EO 12898, issued by President Clinton in 1994, requires that “each Federal agency shall make achieving environmental justice part of its mission by identifying and addressing, as appropriate, disproportionately high and adverse human health or environmental effects of its programs, policies, and activities on

1 minority populations and low-income populations....” In his memorandum
2 transmitting EO 12898 to Federal agencies, President Clinton further specified
3 that, “each Federal agency shall analyze the environmental effects, including
4 human health, economic and social effects, of Federal actions, including effects
5 on minority communities and low-income communities, when such analysis is
6 required by the National Environmental Policy Act [NEPA] of 1969.” Guidance
7 on how to implement EO 12898 and conduct an Environmental Justice analysis
8 has been issued by the President’s Council on Environmental Quality.

9 **4A.1.29.2 Title VI of the Civil Rights Act of 1964**

10 Title VI of the Civil Rights Act of 1964 states that “No person in the United
11 States shall, on the ground of race, color, or national origin be excluded from
12 participation in, be denied the benefits of, or be subjected to discrimination under
13 any program or activity receiving Federal financial assistance.” Title VI bars
14 intentional discrimination, but also unjustified disparate impact discrimination
15 resulting from policies and practices that are neutral on their face (i.e., there is no
16 evidence of intentional discrimination) but have the effect of discrimination on
17 protected groups.

18 **4A.1.29.3 Council on Environmental Quality Guidance for**
19 **Environmental Justice**

20 The CEQ issued guidance in 1997 entitled “Environmental Justice: Guidance
21 under the National Environmental Policy Act” that established the role of
22 EO 12898 as it relates to actions subject to NEPA. The guidance also established
23 the criteria for identifying environmental justice populations and how to consider
24 the involvement of environmental justice groups throughout phases of the
25 NEPA process.

26 **4A.2 State Policies and Regulations**

27 State policies and regulations presented in this appendix are related to
28 requirements that affect surface water, biological, energy, agricultural, air quality
29 and cultural resources. State policies and regulations that affect operations of the
30 Central Valley Project and State Water Project are included in Appendix 3A, No
31 Action Alternative: Central Valley Project and State Water Project Operations,
32 and are not included in this appendix.

33 **4A.2.1 Porter-Cologne Water Quality Control Act**

34 The Porter-Cologne Water Quality Control Act (Porter-Cologne Act) established
35 surface water and groundwater quality guidelines and provided the authority for
36 the SWRCB to protect the state’s surface water and groundwater. Nine RWQCBs
37 have been established to oversee and implement specific water quality activities
38 in their geographic jurisdictions.

39 The Porter-Cologne Act also requires that each RWQCB develop basin plans that
40 establish and periodically review the beneficial uses and water quality objectives
41 for groundwater and surface waterbodies within its jurisdiction. Water quality

1 objectives developed by the regional boards provide specific water quality
 2 guidelines to protect groundwater and surface water to maintain designated
 3 beneficial uses. The SWRCB, through its RWQCBs, is the permitting authority
 4 in California to administer NPDES permits and Waste Discharge Requirements
 5 permits for regulation of waste discharges in the respective jurisdictions.

6 **4A.2.1.1 Regional Water Quality Control Board Basin Plans**

7 The RWQCBs are required to formulate and adopt basin plans for all areas under
 8 their jurisdiction under the Porter-Cologne Act. Each basin plan must contain
 9 water quality objectives to ensure the reasonable protection of beneficial uses, as
 10 well as a program of implementation for achieving water quality objectives with
 11 the basin plans.

12 Section 13050(f) of the Porter-Cologne Act lists the beneficial uses of the waters
 13 of the state that may be protected against water quality degradation, which include
 14 but are not limited to: domestic, municipal, agricultural, and industrial supply;
 15 power generation; recreation; aesthetic enjoyment; navigation; and preservation
 16 and enhancement of fish, wildlife, and other aquatic resources or preserves. Basin
 17 plans must designate and protect beneficial uses in the region. A uniform list of
 18 beneficial uses is defined by the SWRCB; however, each RWQCB may identify
 19 additional beneficial uses specific to local waterbodies.

20 Basin plans must adopt water quality standards to protect public health or welfare,
 21 enhance the quality of water, and serve the purposes of the CWA. These water
 22 quality standards include: designated beneficial uses; water quality objectives to
 23 protect the beneficial uses; implementation of the Federal and state policies for
 24 antidegradation; and general policies for application and implementation.

25 The basin plans are subject to modification, considering applicable laws, policies,
 26 technologies, water quality conditions, and priorities. Basin plans must be
 27 assessed every 3 years for the appropriateness of existing standards and
 28 evaluation and prioritization of basin planning issues. In California, however,
 29 waterbodies are assessed every 2 years for CWA 303(d) and 305(b) requirements.
 30 Revisions are accomplished through basin plan amendments. Once a basin plan
 31 amendment is adopted in noticed public hearings, it must be approved by the
 32 SWRCB Office of Administrative Law and, in some cases, the USEPA.

33 **4A.2.1.2 State Antidegradation Policy**

34 California's Antidegradation Policy, formally known as the Statement of Policy
 35 with Respect to Maintaining High Quality Waters in California (State Water
 36 Board Resolution No. 68-16), restricts degradation of surface waters and
 37 groundwaters. In particular, this policy protects waterbodies where existing
 38 quality is higher than necessary for the protection of beneficial uses. Under the
 39 Antidegradation Policy, any actions that can adversely affect water quality in all
 40 surface waters and groundwaters must:

- 41 • Meet waste discharge requirements which will result in the best practicable
 42 treatment or control of the discharge necessary to assure that a pollution or

- 1 nuisance will not occur and the highest water quality consistent with
2 maximum benefit to the people of the state will be maintained;
- 3 • Not unreasonably affect present and anticipated beneficial use of the
4 water; and
 - 5 • Not result in water quality less than that prescribed in water quality plans
6 and policies.

7 The state Antidegradation Policy meets the requirements of the Federal
8 antidegradation policy.

9 **4A.2.1.3 California Toxics Standards**

10 The Policy for Implementing Toxic Standards for Inland Surface Waters,
11 Enclosed Bays, and Estuaries of California is referred to as the State
12 Implementation Policy. This state policy for water quality control, adopted by the
13 SWRCB on March 2, 2000, and effective by May 22, 2000, applies to discharges
14 of toxic pollutants into the inland surface waters, enclosed bays, and estuaries of
15 California subject to regulation under the State's Porter-Cologne Act (Division 7
16 of the Water Code) and the Federal CWA. Such regulation may occur through
17 the issuance of NPDES permits, or other relevant regulatory approaches. The
18 policy establishes: (1) implementation provisions for priority pollutant criteria
19 promulgated by the USEPA through the National Toxics Rule (40 CFR 131.36)
20 (promulgated on December 22, 1992, and amended on May 4, 1995) and through
21 the California Toxics Rule (40 CFR 131.38) (promulgated on May 18, 2000, and
22 amended on February 13, 2001), and for priority pollutant objectives established
23 by RWQCBs in their water quality control plans; (2) monitoring requirements for
24 2,3,7,8-tetrachlorodibenzodioxin equivalents; and (3) chronic toxicity control
25 provisions. In addition, this policy includes special provisions for certain types of
26 discharges and factors that could affect the application of other provisions in
27 the policy.

28 The California Toxics Rule is applicable to all state waters, as are the USEPA
29 advisory National Recommended Water Quality Criteria. Central Valley and
30 Delta areas are subject to the 2006 Bay-Delta Water Quality Control Plan, and the
31 Central Valley, Tulare Basin, and San Francisco Bay regional plans. Freshwater
32 criteria apply to waters of salinity less than 1 parts per thousand 95 percent or
33 more of the time, seawater criteria are for water greater than 10 parts per thousand
34 95 percent or more of the time, and estuarine waters use the more stringent of the
35 two possible criteria, in absence of estuary-specific criteria.

36 The regulation of mercury contamination is approached through bioaccumulation
37 to fish. In addition to fish fillets protective of human health, the Delta TMDL
38 recommended concentration for mercury in small, whole-body fish to be
39 protective of wildlife is not to exceed 0.03 mg/kg mercury wet weight. Although
40 selenium is regulated through water quality standards, fish and bird egg tissue
41 concentration benchmarks have been developed for use in San Francisco Bay and
42 Delta TMDLs.

1 For evaluation of risks to human health, analyses of fish fillets are most common
2 and were used in California to establish Fish Contaminant Goals and Advisory
3 Tissue Levels, although the fish should be analyzed in the form that people may
4 eat (for example, for some species or ethnic groups, whole-body analyses may be
5 appropriate).

6 **4A.2.1.4 Long-term Irrigated Lands Regulatory Program**

7 The SWRCB and the RWQCBs implement the Irrigated Lands Regulatory
8 Program to regulate discharges to prevent agricultural runoff from impairing
9 surface waters. To protect these waters, the SWRCB and the RWQCBs issue
10 conditional waivers of waste discharge requirements to growers that contain
11 conditions requiring water quality monitoring of receiving waters and corrective
12 actions when impairments are found.

13 **4A.2.1.5 Nonpoint Source Implementation and Enforcement Policy**

14 California's Nonpoint Source Implementation and Enforcement Policy describes
15 how its nonpoint source plan is to be implemented and enforced, in compliance
16 with Section 319 of the CWA, Coastal Zone Act Reauthorization Amendments,
17 and the Porter-Cologne Act. In contrast to point-source pollution that enters
18 waterbodies from discrete conveyances, nonpoint-source pollution enters
19 waterbodies from diffuse sources, such as land runoff, seepage, or hydrologic
20 modification. Nonpoint-source pollution is controlled through implementation of
21 management measures. The nonpoint source program contains recommended
22 management measures for developing areas and construction sites, as well as
23 wetland and riparian areas. Requirements for soil erosion and sediment controls
24 to prevent nonpoint-source sediment discharges to waterways may be
25 incorporated into permits issued by the San Francisco Bay Conservation and
26 Development Commission or other regulatory entities.

27 **4A.2.1.6 California 303(d)/305(b) Integrated Report**

28 The California 303(d)/305(b) Integrated Report is updated biennially, as required
29 by the USEPA, for inclusion in the USEPA's national Water Quality Inventory
30 Report to Congress. The report is composed of the current California 303(d) list
31 and all current listing decisions for contaminants in impaired waterbodies. The
32 statewide report is the compilation of 303(d)/305(b) Integrated Reports submitted
33 by each RWQCB. The final California 303(d) list must be submitted to and
34 approved by the USEPA before it becomes effective.

35 **4A.2.1.7 Central Valley Salinity Alternatives for Long-term Sustainability** 36 **(CV-SALTS)**

37 In 2006, the Central Valley RWQCB, the SWRCB, and stakeholders began a joint
38 effort to address salinity and nitrate problems in California's Central Valley and
39 adopt long-term solutions that will lead to enhanced water quality and economic
40 sustainability. This effort is referred to as the CV-SALTS Initiative. The goal of
41 CV-SALTS is to develop a comprehensive region-wide Salt and Nitrate
42 Management Plan (SNMP) describing a water quality protection strategy that will
43 be implemented through a mix of voluntary and regulatory efforts. The SNMP

1 may include recommendations for numeric water quality objectives, beneficial
2 use designation refinements, and/or other refinements, enhancements, or basin
3 plan revisions. The SNMP will serve as the basis for amendments to the
4 three basin plans that cover the Central Valley Region (the Sacramento River
5 and San Joaquin River Basin Plan, the Tulare Lake Basin Plan, and the
6 Sacramento/San Joaquin Rivers Bay-Delta Plan). The Basin Plan Amendments
7 will likely establish a comprehensive implementation plan to achieve water
8 quality objectives for salinity (including nitrate) in the region's surface waters and
9 groundwater, and the SNMP may include recommendations for numeric water
10 quality objectives, beneficial use designation refinements, and/or other
11 refinements, enhancements, or basin plan revisions.

12 **4A.2.2 California Safe Drinking Water Act**

13 In 1976, California enacted its own Safe Drinking Water Act, requiring the
14 Department of Public Health Services to regulate drinking water, including setting
15 and enforcing Federal and state drinking water standards, administering water
16 quality testing programs, and administering permits for public water system
17 operations. The Federal Safe Drinking Water Act allows the state to enforce its
18 own standards in lieu of the Federal standards so long as they are at least as
19 protective as the Federal standards. Substantial amendments to the California Act
20 in 1989 incorporated the new Federal Safe Drinking Water Act requirements into
21 California law, provided for the state to set more stringent standards, and
22 recommended public health levels for contaminants

23 **4A.2.2.1 Central Valley Regional Water Quality Control Board Drinking** 24 **Water Policy**

25 A multi-year effort is underway to develop a drinking water policy for surface
26 waters in the Central Valley. As water flows out of the Sierra foothills and into
27 the valley, pollutants from a variety of urban, industrial, agricultural, and natural
28 sources affect the quality of water, which leads to drinking water treatment
29 challenges and potential public health concerns. Existing policies and plans lack
30 water quality objectives for several known drinking water constituents of concern,
31 such as disinfection byproduct precursors and pathogens, and do not include
32 implementation strategies to provide effective source water protection. The
33 Central Valley RWQCB committed to development of the Policy in Resolution
34 R5-2004-0091 and later in Resolution R5-2010-0079. The 2010 Resolution also
35 documented progress to date, provided direction for future actions and set
36 deadlines for interim deliverables associated with policy development by
37 July 2013.

38 **4A.2.3 Area of Origin Groundwater Statute**

39 California Water Code 1220 prohibits the pumping of groundwater “for export
40 within the combined Sacramento and Delta–Central Sierra Basins...unless the
41 pumping is in compliance with a groundwater management plan that is adopted
42 by [county] ordinance.” The statute enables, but does not require, the board of
43 supervisors of any county within any part of the combined Sacramento and Delta–
44 Central Sierra Basin to adopt groundwater management plans (GWMPs).

1 **4A.2.4 Groundwater Management Act**

2 Assembly Bill (AB) 3030 (1992, California Water Code sections 10750–10756)
 3 enables water agencies to develop and implement GWMPs to manage the
 4 groundwater resources in the jurisdiction of the participating parties. The state
 5 does not maintain a statewide program or mandate its implementation, but the
 6 legislation provides the guidelines and common framework through which
 7 groundwater management can be implemented. Groundwater management
 8 legislation was amended in 2002 with the passage of Senate Bill (SB) 1938,
 9 which provided additional groundwater management components supporting
 10 eligibility to obtain public funding for groundwater projects. In 2000, AB 3030
 11 enabled the development of the Local Groundwater Assistance grant program to
 12 support local water agencies developing groundwater management programs.

13 **4A.2.5 Groundwater Basin Adjudication Processes**

14 Basin adjudications occur through a court decision at the end of a lawsuit. The
 15 final court decision determines the groundwater rights of all the groundwater
 16 users overlying the basin. In addition, the court decides who the extractors are
 17 and how much groundwater those well owners are allowed to extract, and
 18 appoints a Watermaster whose role is to ensure that the basin is managed in
 19 accordance with the court's decree. The Watermaster must report periodically to
 20 the court. There are currently 23 adjudicated groundwater basins in California,
 21 most of which are located in Southern California.

22 **4A.2.6 California Statewide Groundwater Elevation 23 Monitoring Program**

24 SBX7 6, enacted in November 2009, mandates a statewide groundwater elevation
 25 monitoring program to track seasonal and long-term trends in groundwater
 26 elevations in California's groundwater basins. This amendment to the Water
 27 Code requires the collaboration between local monitoring entities and Department
 28 of Water Resources (DWR) to collect groundwater elevation data. To achieve
 29 this goal, DWR developed the California Statewide Groundwater Elevation
 30 Monitoring (CASGEM) Program to establish a permanent, locally managed
 31 program of regular and systematic monitoring in all of the state's alluvial
 32 groundwater basins.

33 The law requires that local agencies monitor and report the elevation of their
 34 groundwater basins. DWR is required by the law to establish a priority schedule
 35 for monitoring groundwater basins, and to report to the Legislature on the
 36 findings from these investigations (Water Code Section 10920 et seq.). DWR is
 37 developing an online system for a monitoring entity to submit groundwater
 38 elevation data, which will be compatible with DWR's Water Data Library.

39 **4A.2.7 Sustainable Groundwater Management Act**

40 In September 2014, the Sustainable Groundwater Management Act (SGMA) was
 41 enacted. The SGMA establishes a new structure for locally managing
 42 California's groundwater in addition to existing groundwater management

1 provisions established by AB 3030 (1992), SB 1938 (2002), and AB 359 (2011),
2 as well as SBX7 6 (2009).

3 The SGMA includes the following key elements:

- 4 • Provides for the establishment of a Groundwater Sustainability Agency (GSA)
5 by one or more local agencies overlying a designated groundwater basin or
6 subbasin, as established by DWR Bulletin 118-03.
- 7 • Requires all groundwater basins found to be of “high” or “medium” priority to
8 prepare Groundwater Sustainability Plans (GSPs).
- 9 • Provides for the proposed revisions, by local agencies, to the boundaries of a
10 DWR Bulletin 118 basin, including the establishment of new subbasins.
- 11 • Provides authority for DWR to adopt regulations to evaluate GSPs, and
12 review the GSPs for compliance every 5 years.
- 13 • Requires DWR to establish best management practices and technical measures
14 for GSAs to develop and implement GSPs.
- 15 • Provides regulatory authorities for the SWRCB for developing and
16 implementing interim GWMPs under certain circumstances (such as lack of
17 compliance with development of GSPs by GSAs).

18 The SGMA defines sustainable groundwater management as “the management
19 and use of groundwater in a manner that can be maintained during the planning
20 and implementation horizon without causing undesirable results.” Undesirable
21 results are defined as any of the following effects.

- 22 • Chronic lowering of groundwater levels (not including overdraft during a
23 drought if a basin is otherwise managed).
- 24 • Significant and unreasonable reduction of groundwater storage.
- 25 • Significant and unreasonable seawater intrusion.
- 26 • Significant and unreasonable degraded water quality, including the migration
27 of contaminant plumes that impair water supplies.
- 28 • Significant and unreasonable land subsidence that substantially interferes with
29 surface land uses.
- 30 • Depletions of interconnected surface water that have significant and
31 unreasonable adverse impacts on beneficial uses of the surface water.

32 The SGMA requires the formation of GSPs in groundwater basins or subbasins
33 that DWR designates as medium or high priority based upon groundwater
34 conditions identified using the CASGEM results by 2022. Sustainable
35 groundwater operations must be achieved within 20 years following completion
36 of the GSPs.

1 **4A.2.8 California Endangered Species Act**

2 California Fish and Game Code sections 2050–2115.5, otherwise known as the
3 California Endangered Species Act (CESA), state that all native species of fish,
4 wildlife, and plants that are in danger of or threatened with extinction because
5 their habitats are threatened with destruction, adverse modification, or severe
6 curtailment, or because of overexploitation, disease, predation, or other factors,
7 are of ecological, educational, historical, recreational, aesthetic, economic, and
8 scientific value to the people of the state. The CESA also states that the
9 conservation, protection, and enhancement of these species and their habitat is of
10 statewide concern (Fish and Game Code Section 2051).

11 An “Endangered” species is a native species or subspecies of bird, mammal, fish,
12 amphibian, reptile, or plant that is in serious danger of becoming extinct
13 throughout all, or a significant portion, of its range due to one or more causes
14 including loss of habitat, change in habitat, overexploitation, predation,
15 competition, or disease (Fish and Game Code Section 2062). A “threatened”
16 species is a native species or subspecies of bird, mammal, fish, amphibian, reptile,
17 or plant that, although not currently threatened with extinction, is likely to become
18 an endangered species in the foreseeable future in the absence of special
19 protection and management efforts (Fish and Game Code Section 2067). The
20 California Fish and Game Commission is responsible for listing species under
21 CESA, and the California Department of Fish and Wildlife (DFW) is responsible
22 for implementing and enforcing and issuing permits under CESA.

23 CESA strictly prohibits the “take” of any threatened or endangered fish, wildlife
24 or plant species or species listed as threatened or endangered under CESA. Under
25 Section 2081 of the Fish and Game Code, an incidental take permit from DFW is
26 required for projects that could result in the “take” of a species that is state-listed
27 as threatened or endangered, or that is a candidate for listing. Under CESA,
28 “take” is defined as an activity that would directly or indirectly kill an individual
29 of a species, but the definition does not include “harm” or “harass,” as the
30 definition of ESA does. As a result, the threshold for take under CESA may be
31 higher than under the ESA.

32 Under Fish and Game Code Section 2080.1, applicants can notify DFW that they
33 have been issued an incidental take statement/permit pursuant to the ESA for
34 species that are listed under both the ESA and CESA, and can request a
35 consistency determination. If DFW determines that the conditions specified in the
36 Federal incidental take statement/permit are consistent with CESA, a consistency
37 determination can be issued, which allows for incidental take under CESA under
38 the same provisions as under the Federal incidental take statement/permit.

39 **4A.2.9 Natural Community Conservation Planning Act**

40 Sections 2800–2835 of the Fish and Game Code, otherwise known as the Natural
41 Community Conservation Planning Act (NCCP Act), detail the state’s policies on
42 the conservation, protection, restoration, and enhancement of the state’s natural
43 resources and ecosystems. The intent of the legislation is to provide for
44 conservation planning as an officially recognized policy that can be used as a

1 tool to eliminate conflicts between the protection of the state’s natural resources
2 and the need for growth and development. In addition, the legislation promotes
3 conservation planning as a means of coordination and cooperation among private
4 interests, agencies, and landowners, and as a mechanism for multi-species and
5 multi-habitat management. The NCCP Act provides an alternative means for
6 DFW to authorize the incidental take of species listed as threatened or endangered
7 or which are candidates for listing under CESA.

8 **4A.2.10 California Fish and Game Code Section 1600**
9 **(Streambed Alterations)**

10 Sections 1600–1616 of the Fish and Game Code state that it is unlawful for any
11 person or agency to (1) substantially divert or obstruct the natural flow of the bed,
12 channel, or bank of any river, stream, or lake; (2) substantially change the bed,
13 channel, or bank of any river, stream, or lake; (3) use any material from the bed,
14 channel, or bank of any river, stream, or lake; or (4) deposit or dispose of debris,
15 waste, or other material containing crumbled, flaked, or ground pavement where it
16 may pass into any river, stream, or lake in California, without first notifying
17 DFW. With certain exceptions, a Streambed Alteration Agreement must be
18 obtained if DFW determines that substantial adverse effects on existing fish and
19 wildlife resources are expected to occur. The Streambed Alteration Agreement
20 must include measures designed to protect the affected fish and wildlife and
21 associated riparian resources. The regulatory definition of a stream is a body of
22 water that flows at least periodically or intermittently through a bed or channel
23 having banks, and that body of water supports wildlife, fish, or other aquatic life.
24 This includes watercourses having a surface or subsurface flow that supports or
25 has supported riparian vegetation. DFW’s jurisdiction within altered or artificial
26 waterways is based on the value of those waterways to fish and wildlife.

27 **4A.2.11 California Wild and Scenic Rivers Act**

28 In addition to the National Wild and Scenic Rivers System, California has its own
29 system of protected rivers. The California Wild and Scenic Rivers System
30 consists of rivers and river segments established by legislative action because of
31 the scenic, recreational, fishery, or wildlife values that the rivers or segments
32 possess in their free-flowing condition. Sections 5093.50–5093.70 of the Public
33 Resources Code, as established by the Wild and Scenic Rivers Act in 1972, with
34 amendments, state that: “It is the policy of the State of California that certain
35 rivers which possess extraordinary scenic, recreational, fishery, or wildlife values
36 will be preserved in their free-flowing state, together with their immediate
37 environments, for the benefit and enjoyment of the people of the state.” The
38 California Natural Resources Agency must coordinate activities involving the
39 State Wild and Scenic Rivers with Federal, state, and local agencies.

40 All rivers designated as wild, scenic, or recreational by the Federal or state
41 government are regarded as having high scenic quality. The Lower American
42 River, from Nimbus Dam to the Sacramento River, and portions of the Trinity
43 River, downstream of Lewiston Dam, have been designated under both the
44 National and California Wild and Scenic Rivers Systems. The Lower American

1 River is listed by the California Natural Resources Agency as “recreational,” with
 2 trail, boating, rafting, and fishing opportunities. The Trinity River downstream of
 3 Lewiston Dam is also listed by California as “recreational,” offering fishing,
 4 rafting, kayaking, and canoeing.

5 **4A.2.12 Heritage and Wild Trout Program**

6 The California Fish and Game Commission established the Heritage and Wild
 7 Trout Program in 1971 to protect and enhance high quality wild strains of trout
 8 and their habitat. The program designates waters that are managed to protect the
 9 wild strains of trout. Generally, these areas are available for public fishing
 10 without overcrowding and are able to support naturally sustainable trout
 11 populations to allow for appropriate levels of fishing. Management plans are
 12 prepared for the designated wild trout waters to avoid planting of domestic strains
 13 of catchable-sized trout and minimize the potential for planting of hatchery-
 14 produced trout.

15 **4A.2.13 The Salmon, Steelhead Trout, and Anadromous Fisheries** 16 **Program Act**

17 The Salmon, Steelhead Trout, and Anadromous Fisheries Program Act (Fish and
 18 Game Code Section 6900-6903.5) was enacted in 1988 in response to DFW
 19 reporting that the natural production of salmon and steelhead in California had
 20 declined dramatically since the 1940s, primarily as a result of lost stream habitat
 21 on many streams in the state. The Salmon, Steelhead Trout, and Anadromous
 22 Fisheries Program Act declares that it is the policy of the State of California to
 23 increase the state’s salmon and steelhead resources, and directs DFW to develop a
 24 plan and program that strives to double the salmon and steelhead resources (Fish
 25 and Game Code Section 6902(a)). It is also the policy of the state that existing
 26 natural salmon and steelhead habitat shall not be diminished further without
 27 offsetting the impacts of lost habitat (Fish and Game Code Section 6902(c)).

28 **4A.2.14 Marine Invasive Species Act**

29 The Marine Invasive Species Act of 2003 (AB 433) revised and expanded the
 30 Ballast Water Management for Control of Nonindigenous Species Act of 1999 to
 31 more effectively address the threat of nonindigenous species introductions. The
 32 law charged the California State Lands Commission with oversight of the state’s
 33 program to prevent or minimize the introduction of nonindigenous species from
 34 commercial vessels. The current State Lands Commission regulations provide
 35 vessel owners with various options for managing ballast water, including
 36 retention, exchange in mid-ocean waters, treatment, or discharge at the same
 37 location where the ballast water originated.

38 **4A.2.15 California Aquatic Invasive Species Management Plan**

39 Developed by the DFW Invasive Species Program, the California Aquatic
 40 Invasive Species Management Plan provides information that state agencies and
 41 other entities can use to collaborate on addressing aquatic invasive species. The
 42 plan proposes management actions for addressing aquatic invasive species threats
 43 to the state of California. It focuses on the nonnative algae, crabs, clams, fish,

- 1 plants, and other species that continue to invade California’s creeks, wetlands,
2 rivers, bays, and coastal waters. The plan has the following eight major
3 objectives.
- 4 • Improve coordination and collaboration among the people, agencies, and
5 activities involved with aquatic invasive species.
 - 6 • Minimize and prevent the introduction and spread of aquatic invasive species
7 into and throughout the waters of California.
 - 8 • Develop and maintain programs that ensure the early detection of new aquatic
9 invasive species and the monitoring of existing aquatic invasive species.
 - 10 • Establish and manage systems for rapid response and eradication.
 - 11 • Control the spread of aquatic invasive species and minimize their impacts on
12 native habitats and species.
 - 13 • Increase education and outreach efforts to ensure awareness of aquatic
14 invasive species threats and management priorities throughout California.
 - 15 • Increase research on the baseline biology of aquatic invasive species, the
16 ecological and economic impacts of invasions, and control options to improve
17 management.
 - 18 • Ensure state laws and regulations promote the prevention and management of
19 aquatic invasive species introductions.

20 Each objective is supported by a series of strategic actions. The plan meets
21 Federal requirements to develop statewide Nonindigenous Aquatic Nuisance
22 Species Management Plans under Section 1204 of the Nonindigenous Aquatic
23 Nuisance Prevention and Control Act of 1990 (amended as the National Invasive
24 Species Act of 1996). Article 2, Section 64, of the Harbors and Navigation Code
25 authorizes the California Department of Boating and Waterways to manage
26 aquatic weeds impeding the navigation and use of state waterways.

27 **4A.2.16 California Fish and Game Code—Native Plant**
28 **Protection Act**

29 Sections 1900–1913 of the Fish and Game Code codify the Native Plant
30 Protection Act of 1977 (NPPA), which is intended to preserve, protect, and
31 enhance endangered or rare native plants in the state. Under Section 1901, a
32 species is endangered when its prospects for survival and reproduction are in
33 immediate jeopardy from one or more causes. A species is rare when, although
34 not threatened with immediate extinction, it is present in such small numbers
35 throughout its range that it may become endangered if its environment worsens.
36 The California Fish and Game Commission has the authority to designate native
37 plants as “endangered” or “rare,” and DFW has authority to implement and
38 enforce the NPPA. Like CESA, the NPPA strictly prohibits the take of
39 endangered and rare plant species. However, the NPPA contains certain
40 exceptions to this take prohibition that are not included within CESA.

1 DFW maintains a Special Vascular Plants, Bryophytes, and Lichens List for
 2 California as part of the California Natural Diversity Database. The list is
 3 updated quarterly and is reviewed and updated by rare plant status review groups
 4 (more than 300 botanical experts from government, academia, nongovernment
 5 organizations, and the private sector) managed jointly by DFW and California
 6 Native Plant Society (CNPS). Plant species, subspecies, or varieties are assigned
 7 a California Rare Plant Rank (CRPR) based on their level of endangerment.
 8 Plants with CRPR 1A, 1B, or 2 meet the definitions of Section 1901 of the Fish
 9 and Game Code and may qualify for state listing. For plants with a CRPR 3 rank,
 10 DFW and CNPS lack sufficient information to assign them another code. CRPR
 11 4 plants are those of limited distribution and/or those that are infrequently found
 12 within a broader range in California. CNPS believes that CNPR 3 and 4 plants are
 13 uncommon enough to justify their regular monitoring.

14 **4A.2.17 California Fish and Game Code—Fully Protected Species**

15 Sections 3505, 3511, 3513, 3800, 4700, 5050, and 5515 of the Fish and Game
 16 Code pertain to fully protected wildlife species (birds in Sections 3505 through
 17 3800, mammals in Section 4700, reptiles and amphibians in Section 5050, and
 18 fish in Section 5515) and strictly prohibit the take of fully protected species. With
 19 certain narrow exceptions, DFW cannot issue a take permit for fully protected
 20 species; therefore, avoidance measures may be required to avoid take.

21 **4A.2.18 California Energy Commission**

22 California's primary energy policy and planning agency, the California Energy
 23 Commission, was created by the Legislature (the Warren-Alquist Act) in 1974.
 24 The California Energy Commission forecasts future energy needs, promotes
 25 energy efficiency and conservation by setting the state's appliance and building
 26 efficiency standards; supports public interest energy research; develops renewable
 27 energy resources and alternative renewable energy technologies for buildings,
 28 industry, and transportation; licenses thermal power plants that are 50 megawatts
 29 or larger; and plans and directs state response to energy emergencies.

30 **4A.2.19 California Department of Conservation**

31 The California Department of Conservation administers policies to promote
 32 environmental health, economic vitality, informed land use decisions, and
 33 management of the state's natural resources, including agricultural resources.
 34 One of the programs is implemented in accordance with the Williamson Act to
 35 discourage conversion of agricultural land to non-agricultural use by offering
 36 landowners tax incentives for entering into a minimum 10-year contract to
 37 preserve no less than 100 acres of agricultural land.

38 As part of the Land Inventory and Monitoring program, definitions were
 39 established for designations of Important Farmlands which include Prime
 40 Farmland, Farmland of Statewide Importance, Unique Farmland, and Farmland of
 41 Local Importance. Farmland maps are created by the Farmland Mapping and
 42 Monitoring Program under the direction of the USDA. Prime Farmland is defined
 43 by soil quality, groundwater elevation, water supplies, flooding, erodibility,

1 permeability, rock fragment content, and rooting depth to produce sustained high
2 crop yields. Farmland of Statewide Importance includes lands not designated as
3 Prime Farmland that have a good combination of most of the physical and
4 chemical characteristics for the production of crops. Unique Farmland includes
5 particular characteristics for high quality and/or high yield of a specific crop
6 (e.g., rice).

7 **4A.2.20 Delta Protection Act of 1992**

8 The Delta Protection Act (Public Resources Code Section 21080.22) includes a
9 series of findings and declarations related to the quality of the Delta environment
10 and emphasizes the national, state, and local importance of protecting the unique
11 resources of the Delta. The act mandated a state-level planning effort to address
12 the needs of Delta communities. The Delta Protection Commission (DPC) was
13 made a permanent state agency in 2000 because a need for continued planning
14 and management was identified. The DPC has planning jurisdiction over portions
15 of five counties: Contra Costa, Sacramento, San Joaquin, Solano, and Yolo. It
16 was charged with developing a comprehensive regional plan to guide land use and
17 resource management, including wildlife habitat and recreation. The resulting
18 Land Use and Resource Management Plan for the Primary Zone of the Delta was
19 initially adopted by the DPC in February 1995 and updated in November 2010.
20 The plan has eight policy areas: Environment, Utilities and Infrastructure, Land
21 Use and Development, Water and Levees, Agriculture, Recreation and Access,
22 Marine Patrol, and Boater Education and Safety Programs. With the adoption of
23 the management plan, all local governments with incorporated areas in the Delta
24 Primary Zone must submit proposed amendments to their general plans to the
25 DPC. The DPC then reviews the proposed amendments to ensure they are
26 consistent with the Land Use and Resource Management Plan for the Primary
27 Zone of the Delta.

28 **4A.2.21 Sacramento-San Joaquin Delta Reform Act of 2009**

29 In November 2009, the California Legislature enacted SBX7 1, one of several
30 bills passed at that time related to water supply reliability, ecosystem health, and
31 the Delta. SBX7 1 took effect on February 3, 2010. Division 35 of this
32 legislation, also known as the Sacramento-San Joaquin Delta Reform Act of 2009
33 (Delta Reform Act), requires the development of a legally enforceable,
34 comprehensive, long-term management plan for the Delta, referred to as the Delta
35 Plan. The Delta Stewardship Council was established as an independent state
36 agency by the Delta Reform Act.

37 The Delta Stewardship Council's primary responsibility is to develop, adopt, and
38 implement the Delta Plan, a legally enforceable, comprehensive, long-term
39 management plan for the Delta and the Suisun Marsh that achieves the coequal
40 goals (Water Code Section 85300(a)) of (1) providing a more reliable water
41 supply for California and (2) protecting, restoring and enhancing the Delta
42 ecosystem. The coequal goals shall be achieved in a manner that protects and
43 enhances the unique cultural, recreational, natural resource, and agricultural
44 values of the Delta as an evolving place (Water Code Section 85054).

- 1 Achieving the coequal goals is a primary and fundamental purpose of the Delta
 2 Plan. Additionally, the Delta Reform Act (Water Code Section 85020 et seq.)
 3 states that the policy of the state is “to achieve the following objectives as
 4 inherent in the coequal goals for the management of the Delta:
- 5 • Manage the Delta’s water and environmental resources and the water
 6 resources of the state over the long term.
 - 7 • Protect and enhance the unique cultural, recreational, and agricultural values
 8 of the California Delta as an evolving place.
 - 9 • Restore the Delta ecosystem, including its fisheries and wildlife, as the heart
 10 of a healthy estuary and wetland ecosystem.
 - 11 • Promote statewide water conservation, water use efficiency, and sustainable
 12 water use.
 - 13 • Improve water quality to protect human health and the environment consistent
 14 with achieving water quality objectives in the Delta.
 - 15 • Improve the water conveyance system and expand statewide water storage.
 - 16 • Reduce risks to people, property, and state interests in the Delta by effective
 17 emergency preparedness, appropriate land uses, and investments in flood
 18 protection.
 - 19 • Establish a new governance structure with the authority, responsibility,
 20 accountability, scientific support, and adequate and secure funding to achieve
 21 these objectives.”

22 **4A.2.22 McAteer-Petris Act and the San Francisco Bay Plan**

23 The McAteer-Petris Act, enacted on September 17, 1965, was designed to
 24 preserve San Francisco Bay from indiscriminate filling and established the
 25 San Francisco Bay Conservation and Development Commission (BCDC) as a
 26 temporary state agency charged with preparing a plan for the long-term use of the
 27 bay and regulating development in and around the bay. To this end, BCDC
 28 prepared the San Francisco Bay Plan. In August 1969, the McAteer-Petris Act
 29 was amended to make BCDC a permanent agency and to incorporate the policies
 30 of the San Francisco Bay Plan into state law. Bay Plan maps and policies guide
 31 the protection of the San Francisco Bay and its tributary waterways, marshes,
 32 managed wetlands, salt ponds, and shoreline. Plan maps identify areas designated
 33 for “priority uses” that include wildlife refuges, waterfront parks, beaches, water-
 34 related industry, and ports. The Bay Plan also identifies other land designations,
 35 such as tidal marshes, salt ponds, and managed wetlands.

36 BCDC’s Suisun Marsh Protection Plan contains findings that recognize the value
 37 of the aesthetic resources of the Suisun Marsh, as well as adjacent upland
 38 grasslands, cultivated areas, and seasonal marshes. The plan is intended “to
 39 preserve the integrity and assure continued wildlife use” and establishes that the
 40 Suisun Marsh “represents a unique and irreplaceable resource to the people of the
 41 state and nation.” The plan includes specific building and landscape criteria for

1 development along the eastern boundary of the Suisun Marsh in southern
2 Solano County.

3 **4A.2.23 State Lands Commission**

4 The California State Lands Commission (SLC) was established in 1938 with
5 authority under Division 6 of the California Public Resources Code. The SLC
6 provides stewardship of the California lands and waterways entrusted to its care.
7 Nearly 4 million acres of “sovereign lands” are owned by the state. This includes
8 the beds of navigable streams, rivers, and lakes, tidal waterways, and tidelands up
9 to the ordinary high water mark and submerged lands along the coastline
10 extending from the shoreline out to 3 miles offshore. SLC may lease sovereign
11 lands for any public trust purpose, including open space, fisheries, commerce,
12 recreation, and navigation. A public or private entity must lease sites for marinas
13 and recreational piers that are within sovereign lands. SLC also issues permits for
14 dredging lands within its jurisdiction.

15 **4A.2.24 California Mulford-Carrell Act**

16 The 1969 Mulford-Carrell Act established the California Air Resources Board
17 (ARB). The ARB’s mission is to promote and protect public health, welfare, and
18 ecological resources through improved air quality. The ARB oversees the
19 activities of local and regional air quality districts.

20 **4A.2.25 California Clean Air Act**

21 The California Clean Air Act (CCAA) provides the state with a comprehensive
22 framework for air quality planning regulation. Prior to passage of the act, Federal
23 law contained the only comprehensive planning framework. The CCAA requires
24 attainment of state ambient air quality standards by the earliest practicable date.

25 **4A.2.25.1 California Ambient Air Quality Standards and State Air
26 Quality Designations**

27 The ARB administers air quality policy in California, establishes statewide
28 standards, and administers the state’s mobile-source emissions control program,
29 which is described below. In addition, the ARB oversees air quality programs
30 established by state statute. The ARB oversees programs to achieve the
31 California Ambient Air Quality Standards (CAAQS), which were established in
32 1969 pursuant to the Mulford-Carrell Act. These standards are generally more
33 stringent and apply to more pollutants than the NAAQS. In addition to the
34 criteria pollutants, CAAQS have been established for visibility-reducing
35 particulates, hydrogen sulfide, and sulfates.

36 **4A.2.25.2 State Implementation Plans**

37 Federal clean air laws require nonattainment areas with unhealthy levels of
38 criteria air pollutants to develop plans to detail actions that will be undertaken to
39 achieve the NAAQS. These comprehensive plans are known as State
40 Implementation Plans, or SIPs. In addition, the CCAA requires local air districts
41 in nonattainment areas of the state to prepare and maintain Air Quality
42 Management Plans (AQMPs) to achieve compliance with CAAQS. These

1 AQMPs also serve as a basis for preparing the SIP for the state of California,
2 which must ultimately be approved by the USEPA and codified in the CFR.

3 SIPs are a compilation of new and previously submitted plans, programs (such as
4 monitoring, modeling, and permitting), district rules, state regulations, and
5 Federal control requirements. Many of California's SIPs rely on the same core set
6 of control strategies, including emission standards for cars and heavy trucks, fuel
7 standards and requirements, and limits on emissions from consumer products.
8 State law establishes the ARB as the lead agency for all purposes related to the
9 SIP. Local air districts and other agencies, such as the Bureau of Automotive
10 Repair, prepare SIP elements and submit them to the ARB for review and
11 approval. The ARB forwards SIP revisions to the USEPA for approval and
12 publication in the *Federal Register*. CFR Title 40, Chapter I, Part 52, Subpart F,
13 Section 52.220 lists all the items included in the California SIP. The
14 promulgation of the new national 8-hour ozone standard and PM_{2.5} standards has
15 resulted in additional statewide air quality planning efforts. The California
16 Regional Haze Plan has been drafted to reduce regional haze and improve
17 visibility in national parks and wilderness areas. Many additional California SIP
18 submittals are pending USEPA approval.

19 In addition to the SIPs aimed at attainment of the NAAQS, the CCAA requires
20 nonattainment areas to achieve and maintain the CAAQS by the earliest
21 practicable date. Local air districts must develop plans to attain the state ozone,
22 CO, sulfur dioxide, and NO₂ standards. The CCAA also requires that, by the end
23 of 1994 and once every 3 years thereafter, the local air districts must assess their
24 progress toward attaining the air quality standards. The triennial assessment is to
25 report the extent of air quality improvement and the amounts of emission
26 reductions achieved from control measures for the preceding 3-year period. The
27 districts must review and revise their attainment plans, if necessary, to correct for
28 deficiencies in meeting progress, incorporate new data or projections, mitigate
29 ozone transport, and expedite adoption of all feasible control measures. In
30 addition to the triennial progress assessment requirement, local air districts must
31 prepare an annual progress report and submit the report to the ARB by December
32 31 of each year. At a minimum, the annual progress report contains the proposed
33 and actual dates for the adoption and implementation of each measure listed in the
34 previous 3-year plan.

35 **4A.2.25.3 Air Toxics Programs**

36 In addition to the criteria pollutants, concern about non-criteria pollutants has
37 increased in recent years. AB 1807 (the Tanner Bill, passed in 1983) established
38 the California Air Toxics Program for identifying and developing emissions
39 control and reduction methods for toxic air contaminants (TACs). The bill
40 formally designated 18 substances as TACs. In 1993, the 189 HAPs identified by
41 the USEPA were incorporated into California law as TACs. Other pollutants
42 have been added more recently, such as PM emissions from diesel-fueled engines
43 (diesel PM), designated by California as a carcinogen. The California Air Toxics
44 Program also includes provisions for public awareness and risk reduction.

1 Local agencies, such as air districts, are responsible for evaluating and controlling
2 TAC emissions, especially when these emissions are released from projects near
3 sensitive receptors. For example, AB 3205 requires that new or modified sources
4 of TACs near schools provide public notice to the parents of schoolchildren
5 before a permit to emit air pollutants is issued. One air toxics control measure
6 adopted by ARB in 2004 prohibited operation of diesel-fueled backup engines
7 within 500 feet of a school during school hours, unless used in an emergency.

8 The Air Toxics “Hot Spots” Information and Assessment Act was enacted in
9 September 1987. The act requires that toxic air emissions from stationary sources
10 (facilities) be quantified and compiled into an inventory, that risk assessments be
11 conducted according to methods developed by the California Office of
12 Environmental Health Hazard Assessment, and that the public be notified of
13 significant risks posed by nearby facilities. Facilities that pose a potentially
14 significant health risk to the public are required to reduce their risks.

15 **4A.2.25.4 Mobile-Source Emission Control Programs**

16 The ARB is responsible for developing statewide programs and strategies to
17 reduce the emission of smog-forming pollutants and TACs by mobile sources.
18 To attain the CAAQS, the CCAA mandates that the ARB achieve the maximum
19 degree of emission reductions from all on- and off-road mobile sources. On-road
20 sources include passenger cars, motorcycles, trucks, and buses; off-road sources
21 include heavy-duty construction equipment, recreational vehicles, marine vessels,
22 lawn and garden equipment, and small utility engines. On-road vehicle emission
23 control programs overseen by the ARB include vehicle inspections, idling
24 restrictions, requirements for clean vehicle fleets, voluntary vehicle retirement
25 programs, and engine emissions standards.

26 Additionally, exhaust emission standards have been adopted by the ARB and the
27 USEPA for off-road engines. The ARB has extensive statewide programs
28 underway to reduce diesel PM.

29 **4A.2.26 State Policies and Regulations Related to Greenhouse** 30 **Gas Emissions**

31 A summary of state regulations and standards related to GHG emissions is
32 provided below. California Senate and Assembly bills and executive orders, such
33 as SB 1771, AB 1493, SB 1078, SB 107, EOs S-14-08 and S-1-07, SB 1368,
34 SB 97, and SB 375 have been developed to define various aspects of GHG
35 recordkeeping and implementation of GHG emission reduction measures, such as
36 the California Renewables Portfolio Standard Program for statewide energy
37 supplies and the Low Carbon Fuel Standard. These bills and orders are not
38 discussed further in this document because they are not directly applicable to the
39 Proposed Project or any of the alternatives. Other bills, executive orders, and
40 plans, such as AB 32, EO S 3-05, the Climate Change Scoping Plan, the Climate
41 Change Adaptation Strategy, and California Environmental Quality Act (CEQA)
42 guidance, are discussed further. These bills and plans generally define the
43 regulatory setting for projects that emit GHGs in California and describe

1 regulatory agency goals for statewide GHG emissions reductions and climate
 2 change adaptation.

3 **4A.2.26.1 Executive Order S-3-05 (California)**

4 EO S-3-05 was signed into law in 2005 and calls for a reduction of GHG
 5 emissions to 2000 levels by 2010, a reduction of GHG emissions to 1990 levels
 6 by 2020, and a reduction of GHG emissions to 80 percent below 1990 levels by
 7 2050. The order directs the California Environmental Protection Agency
 8 (CalEPA) Secretary to coordinate development and implementation of strategies
 9 to achieve the GHG reduction targets in conjunction with the Secretary of the
 10 Business, Transportation, and Housing Agency; the Secretary of the Department
 11 of Food and Agriculture; the Secretary of the Natural Resources Agency; the
 12 Chairperson of ARB; the Chairperson of the California Energy Commission; and
 13 the President of the California Public Utilities Commission. CalEPA developed
 14 the Climate Action Team made up of representatives from the agencies listed
 15 above to implement the strategies to reduce GHG emissions. The order also
 16 includes a requirement for CalEPA to report annually to the Governor and
 17 Legislature. The first report, Climate Action Team Proposed Early Actions to
 18 Mitigate Climate Change in California, was released in March 2006, and reports
 19 have been published each year since. ARB released its Expanded List of Early
 20 Action Measures in October 2007.

21 **4A.2.26.2 California Global Warming Solutions Act of 2006**
 22 **(Assembly Bill 32)**

23 On September 20, 2006, California adopted the California Global Warming
 24 Solutions Act of 2006 (generally referred to as AB 32 and codified at Section 1,
 25 Division 25.5, and Section 38500 et seq. of the California Health & Safety Code).
 26 This law requires ARB to design and implement emission limits, regulations, and
 27 other measures such that statewide GHG emissions are reduced in a
 28 technologically feasible and cost-effective manner to 1990 levels by 2020
 29 (representing a 25 percent reduction). AB 32 does not directly amend other
 30 environmental laws, such as CEQA. Instead, it creates a program to identify
 31 GHG sources, prioritize sources for regulation based on significance of
 32 contributions to California GHG emissions, and regulate priority sources. Under
 33 AB 32, ARB is required to complete certain actions. As of May 2012, ARB has:

- 34 • Determined that the statewide GHG emissions inventory in 1990 was
 35 approved as a statewide GHG emissions limit to be achieved by 2020.
- 36 • Identified significant sources or categories of sources of each GHG and
 37 established protocols and procedures for monitoring, quantifying, and
 38 reporting such emissions.
- 39 • Issued a scoping plan to achieve emission reductions from specific sources or
 40 categories of sources by January 1, 2009.
- 41 • Adopted and begun enforcement of regulations to implement a suite of
 42 discrete actions by January 1, 2010.

- 1 • Adopted GHG emissions limits and reduction measures by January 1, 2011.
- 2 • Enforced GHG emission limits and reduction measures, beginning on
- 3 January 1, 2012.

4 California lead agencies have relied upon local air pollution control districts to
5 provide guidance on the evaluation of air pollutants under CEQA. As a result of
6 AB 32, both ARB and the local air districts will have regulatory jurisdiction over
7 GHG emissions in California. AB 32 identifies ARB as the state agency
8 responsible for the design and implementation of emissions limits, regulations,
9 and other measures to meet targets.

10 In December 2007, ARB approved the 2020 emission limit (1990 level) of
11 427 million tpy CO₂e of GHGs. The 2020 target requires the reduction of
12 169 million tpy CO₂e, or approximately 30 percent below the state's projected
13 "business-as-usual" 2020 emissions of 596 million tpy CO₂e.

14 **4A.2.26.3 Climate Change Scoping Plan**

15 On December 11, 2008, pursuant to AB 32, ARB adopted the Climate Change
16 Scoping Plan. This plan outlines how emissions reductions will be achieved from
17 significant sources of GHGs via regulations, market mechanisms, and other
18 actions. Six key elements, outlined in the scoping plan, are identified to achieve
19 emissions reduction targets:

- 20 • Expand and strengthen existing energy efficiency programs and building and
21 appliance standards;
- 22 • Achieve a statewide renewable energy mix of 33 percent;
- 23 • Develop a California cap-and-trade program that links with other Western
24 Climate Initiative partner programs to create a regional market system;
- 25 • Establish targets for transportation-related GHG emissions for regions
26 throughout California, and pursue policies and incentives to achieve those
27 targets;
- 28 • Adopt and implement measures pursuant to existing state laws and policies,
29 including California's clean car standards, goods movement measures, and the
30 Low Carbon Fuel Standard; and
- 31 • Create targeted fees, including a public goods charge on water use, fees on
32 high global warming potential gases, and a fee to fund the administrative costs
33 of the state's long-term commitment to AB 32 implementation.

34 The Climate Change Scoping Plan also recommended 39 measures that were
35 developed to reduce GHG emissions from key sources and activities while
36 improving public health, promoting a cleaner environment, preserving our natural
37 resources, and ensuring that the impacts of the reductions are equitable and do not
38 disproportionately impact low-income and minority communities. These
39 measures also put the state on a path to meet the long-term 2050 goal of reducing
40 California's GHG emissions to 80 percent below 1990 levels. In 2011, the
41 Functional Equivalent Document for the Scoping Plan was amended.

1 The Scoping Plan was reapproved by the ARB on August 24, 2011, including the
 2 Final Supplement to the Functional Equivalent Document. According to the Final
 3 Supplement, the majority of additional measures in the Climate Change Scoping
 4 Plan were adopted (as of 2012) and are currently in place.

5 **4A.2.26.4 Executive Order S-13-08, Climate Change Adaptation Strategy**
 6 EO S-13-08, issued November 14, 2008, directs the California Natural Resources
 7 Agency, DWR, Office of Planning and Research, California Energy Commission,
 8 SWRCB, State Parks Department, and California's coastal management agencies
 9 to participate in a number of planning and research activities to advance
 10 California's ability to adapt to the impacts of climate change. The order
 11 specifically directs agencies to work with the National Academy of Sciences to
 12 initiate the first California Sea Level Rise Assessment and to review and update
 13 the assessment every 2 years after completion, immediately assess the
 14 vulnerability of the California transportation system to sea level rise, and to
 15 develop a California Climate Change Adaptation Strategy.

16 Prepared in cooperation and partnership with multiple state agencies, the 2009
 17 California Climate Adaptation Strategy summarizes the best known science on
 18 climate change impacts in seven specific sectors (public health, biodiversity and
 19 habitat, ocean and coastal resources, water management, agriculture, forestry, and
 20 transportation and energy infrastructure) and provides recommendations on how
 21 to manage those threats.

22 **4A.2.26.5 California Greenhouse Gas Cap-and-Trade Program**
 23 On October 20, 2011, ARB adopted the final cap-and-trade program for
 24 California. The California cap-and-trade program creates a market-based system
 25 with an overall emissions limit for affected sectors. The program is currently
 26 proposed to regulate more than 85 percent of California's emissions and will
 27 stagger compliance requirements according to the following schedule:
 28 (1) electricity generation and large industrial sources by 2012; and (2) fuel
 29 combustion and transportation by 2015.

30 **4A.2.27 California Register of Historical Resources**
 31 The California Register of Historical Resources (CRHR) includes resources that
 32 are listed in or formally determined eligible for listing in the NRHP and some
 33 California State Landmarks and Points of Historical Interest. Properties of local
 34 significance that have been designated under a local preservation ordinance (local
 35 landmarks or landmark districts) or that have been identified in a local historical
 36 resources inventory may be eligible for listing in the CRHR and are presumed to
 37 be significant resources for purposes of CEQA unless a preponderance of
 38 evidence indicates otherwise (California Public Resources Code Section 5024.1;
 39 Title 14, California Code of Regulations Section 4850). The eligibility criteria for
 40 listing in the CRHR are similar to those for NRHP listing but focus on the
 41 relevance of the resources to California history and heritage. A cultural resource
 42 may be eligible for listing in the CRHR if it has significance under one or more of
 43 the following criteria:

- 1 • Associated with events or patterns of events that have made a significant
2 contribution to the broad patterns of local or regional history, or the cultural
3 heritage of California or the United States.
- 4 • Associated with the lives of persons important to local, California, or national
5 history.
- 6 • Embodies the distinctive characteristics of a type, period, region, or method of
7 construction, or represents the work of a master, or possesses high artistic
8 values.
- 9 • Has yielded, or has the potential to yield, information important to the
10 prehistory or history of the local area, California, or the nation.

11 To be eligible, a resource must also have integrity. The CRHR definition of
12 “integrity” is slightly different than that for the NRHP. Integrity is defined as
13 “the authenticity of a historical resource’s physical identity evidenced by the
14 survival of characteristics that existed during the resource’s period of
15 significance.” The Office of Historic Preservation guidance further states that
16 eligible resources must “retain enough of their historic character or appearance to
17 be recognizable as historical resources and to convey the reasons for their
18 significance” and lists the same seven aspects of integrity used for evaluating
19 properties under the NRHP criteria. The CRHR’s special considerations for
20 certain property types are limited to: (1) moved buildings, structures, or objects;
21 (2) historical resources achieving significance within the past 50 years; and
22 (3) reconstructed buildings (14 California Code of Regulations Section 4852).

23 **4A.2.28 Native American Heritage Commission**

24 The duties and role of the Native American Heritage Commission (NAHC),
25 which is located in Sacramento, are described in Public Resources Code (PRC)
26 sections 5097.9 through 5097.991. State and local agencies are required by
27 the PRC to cooperate with the NAHC regarding disposition of Native
28 American resources.

29 The NAHC maintains a catalog of places of special religious or social
30 significance to Native Americans. This database, known as the Sacred Lands
31 File, includes information on known Native American graves and cemeteries on
32 private lands and other places of cultural or religious significance to the Native
33 American community.

34 The NAHC also performs other duties regarding the preservation and accessibility
35 of sacred sites and burials and the disposition of Native American human remains
36 and burial items as described below.

37 **4A.2.29 California Public Resources Code and California Health and 38 Safety Code Provisions Regarding Human Remains**

39 In California, when human remains are discovered outside of a cemetery, the
40 relevant county coroner determines whether the remains are archaeological in
41 nature or represent evidence of a crime (which would require the coroner to
42 determine cause of death). When the coroner determines that the remains are of

1 prehistoric Native American origin, he or she contacts the NAHC (Health and
2 Safety Code Section 7050.5(b) and (c)).

3 The following procedures only apply to Native American remains found in
4 California on non-federal lands. When the NAHC receives notification of a
5 discovery of Native American human remains from a county coroner, it notifies
6 those persons it believes to be the most likely descendants of the deceased Native
7 American. The descendants may, with the permission of the landowner or his or
8 her authorized representative, inspect the site of the discovery of the Native
9 American human remains and recommend to the owner or the person responsible
10 for the excavation work means for treatment or disposition, with appropriate
11 dignity, of the human remains and any associated grave goods. The descendants
12 must complete their inspection and make recommendations or express preferences
13 for treatment within 48 hours of being granted access to the site.

14 Upon the discovery of Native American remains, the landowner is required to
15 ensure that the immediate vicinity of the find is not damaged or disturbed by
16 further development activity until the most likely descendants make their
17 recommendations. The landowner (and, necessarily, the archaeological team)
18 must confer with the descendants on all reasonable options regarding the
19 descendants' preferences for treatment. The preferences may include, but not be
20 limited to, at the descendants' discretion, further archaeological excavation and
21 scientific study of the remains, immediate removal by the descendants to a site of
22 their choice for reburial in accordance with their traditions, or scientific
23 exhumation and study followed by reburial by the descendants.

24 **4A.2.30 Fire Hazard Severity Zones**

25 In accordance with PRC sections 4201–4204 and Government Code sections
26 51175–51189, the California Department of Forestry and Fire Prevention
27 (CAL FIRE) has mapped areas of significant fire hazards based on fuels, terrain,
28 weather, and other relevant factors. The zones are referred to as Fire Hazard
29 Severity Zones and represent the risks associated with wildland fires. Under
30 CAL FIRE regulations, areas within very high fire-hazard risk zones must comply
31 with specific building and vegetation requirements intended to reduce property
32 damage and loss of life within these areas.

33 **4A.2.31 Mosquito Abatement Act**

34 In 1915, the State Legislature enacted the Mosquito Abatement Act, which
35 allowed local mosquito abatement organizations to form into specific special
36 districts. Mosquito abatement districts use a combination of abatement
37 procedures to control mosquitoes. Generally, mosquito control methods used
38 selectively, singly, or in combination include biological agents, such as
39 mosquitofish, which eat mosquito larvae; source reductions, such as draining the
40 waterbodies that produce mosquitoes; pesticides; ecological manipulations of
41 mosquito breeding habitat; and public education on preventive measures.

1 **4A.2.32 California Vector Control Laws and Regulations**

2 In California, local vector control agencies have the authority to conduct
3 surveillance for vectors, prevent the occurrence of vectors, and abate production
4 of vectors (California Codes: Health and Safety Code Section 2040). Vector
5 control agencies also have authority to participate in review, comment, and make
6 recommendations regarding local, state, or Federal land use planning and
7 environmental quality processes, documents, permits, licenses, and entitlements
8 for projects and their potential effects with respect to vector production
9 (California Codes: Health and Safety Code Section 2041).

10 Additionally, agencies have broad authority to influence landowners to reduce or
11 “abate” the source of a vector problem. Actions may include imposing civil
12 penalties of up to \$1,000 per day plus costs associated with controlling the vector.
13 Agencies have authority to “abate” vector sources on private and publicly owned
14 properties (California Codes: Health and Safety Code sections 2060–2065).

15 Mosquito and vector control programs that enter into a cooperative agreement
16 with the California Department of Health Services are exempted from some
17 pesticide-related laws under Title 3 of the California Code of Regulations
18 Section 6620. Specifically, these agencies are exempted from “Consent to
19 Apply” (Title 3 California Code of Regulations Section 6616), “Notice” (Title 3
20 California Code of Regulations Section 6618), and the “Protection of Persons,
21 Animals, and Property” (Title 3 California Code of Regulations Section 6614).
22 Essentially, these provisions allow the vector control agency to apply a pesticide
23 to a property in the interest of preserving the public health, without notifying or
24 obtaining permission from the landowner beforehand.

25 A vector control technician working at a vector control agency must be a
26 “certified technician” or work under the direct supervision of a “certified
27 technician” to apply pesticides. Vector control technicians achieve certification
28 through an examination process administered by the California Department of
29 Health Services.

30 Vector control agencies cannot use any pesticide not registered for use in
31 California, and are required to keep detailed records of each pesticide application,
32 including date, location, and amount applied. All pesticides must be applied in
33 accordance with the labeling of the product as registered with the USEPA.

34 **4A.2.33 California Environmental Justice Policies**

35 **4A.2.33.1 Environmental Justice – Senate Bill 115**

36 SB 115 established the State of California as the first state to define
37 environmental justice. Senate Bill 115 defines environmental justice as “the fair
38 treatment of people of all races, cultures and income with respect to development,
39 adoption and implementation of environmental laws, regulations and policies.”
40 SB 115 added this language to California Government Code Section 65040.12
41 and to Division 34 of the Public Resources Code relating to environmental
42 quality. Finally, it also established the Governor’s Office of Planning and
43 Research as the coordinating agency for state programs and requested that

1 CalEPA establish a model environmental justice policy for its boards,
2 departments, and offices.

3 **4A.2.33.2 California Natural Resources Agency Environmental**
4 **Justice Policy**

5 The California Natural Resources Agency defines “environmental justice” in a
6 manner consistent with the State of California as “the fair treatment of people of
7 all races, cultures and income with respect to the development, adoption,
8 implementation, and enforcement of environmental laws, regulations, and
9 policies.” The agency states that its environmental justice policy is that the fair
10 treatment of all people shall be considered during the planning, decision making,
11 development, and implementation of its programs. The California Natural
12 Resources Agency intends for its policy “to ensure that the public, including
13 minority and low-income populations, are informed of opportunities to participate
14 in the development and implementation of all Resources Agency programs,
15 policies and activities, and that they are not discriminated against, treated unfairly,
16 or caused to experience disproportionately high and adverse human health or
17 environmental effects from environmental decisions.”

This page left blank intentionally.

1 **Appendix 5A**

2 **CalSim II and DSM2 Modeling**

3 This appendix provides information about the methods and assumptions used for
4 the Remanded Biological Opinions on the Coordinated Long-Term Operation of
5 the Central Valley Project (CVP) and State Water Project (SWP) Environmental
6 Impact Statement (EIS) environmental consequences analysis using the CalSim II
7 and DSM2 models. This appendix is organized in three main sections:

- 8 • CalSim II and DSM2 Modeling Methodology
9 • CalSim II and DSM2 Modeling Simulations and Assumptions
10 • CalSim II and DSM2 Modeling Results

11 An outline is provided at the beginning of each section.

This page left blank intentionally.

1 **Appendix 5A, Section A**

2 **CalSim II and DSM2 Modeling**
 3 **Methodology**

4 This section summarizes the modeling methodology used to analyze the
 5 No Action Alternative, Second Basis of Comparison, and other alternatives in this
 6 Environmental Impact Statement (EIS). It describes the overall analytical
 7 framework and contains descriptions of the key analytical tools and approaches
 8 used in the environmental consequences evaluation for the alternatives.
 9 Appendix 5A, Section A is organized as follows:

- 10 • Introduction
- 11 • Overview of the Modeling Approach
 - 12 – Analytical Tools
 - 13 – Key Components of the Analytical Framework
 - 14 – Climate Change and Sea-Level Rise
- 15 • Hydrology and System Operations
 - 16 – CalSim II
 - 17 – Artificial Neural Network for Flow-Salinity Relationship
 - 18 – Application of CalSim II to Evaluate EIS Alternatives
 - 19 – Output Parameters
 - 20 – Appropriate Use of CalSim II Results
 - 21 – Linkages to Other Models
- 22 • Delta Hydrodynamics and Water Quality
 - 23 – Overview of Hydrodynamics and Water Quality Modeling Approach
 - 24 – Delta Simulation Model (DSM2)
 - 25 – Application of DSM2 to Evaluate EIS Alternatives
 - 26 – Output Parameters
 - 27 – Modeling Limitations
 - 28 – Linkages to Other Models
- 29 • Climate Change and Sea-Level Rise
 - 30 – Climate Change
 - 31 – Sea-Level Rise
 - 32 – Incorporating Climate Change and Sea-Level Rise in EIS Simulations
 - 33 – Climate Change and Sea-Level Rise Modeling Limitations
- 34 • References

1 **5A.A.1 Introduction**

2 This EIS includes identifying effects of operations considered until Year 2030 and
3 the hydrologic response of the system to those operations. For modeling
4 purposes, the alternatives are simulated at Year 2030; and in the evaluation of all
5 alternatives at Year 2030, climate change and sea-level rise of 15 centimeters
6 (cm) were assumed to be inherent.

7 The analytical framework and the tools used for the environmental consequences
8 analysis are described in this section. Modeling assumptions for all the
9 alternatives are provided in Section B of this appendix.

10 **5A.A.2 Overview of the Modeling Approach**


11 To support the impact analysis of the alternatives, numerical modeling of physical
12 variables (or “physically based modeling”), such as river flows and water
13 temperature, is required to evaluate changes to conditions affecting resources in
14 the Central Valley including the Sacramento-San Joaquin Delta (Delta). A
15 framework of integrated analyses including hydrologic, operations,
16 hydrodynamics, water quality, and fisheries analyses is required to provide
17 information for the comparative National Environmental Policy Act (NEPA)
18 assessment of several resources, such as water supply, surface water,
19 groundwater, and aquatic resources.

20 The alternatives include operational changes in the coordinated operation of the
21 Central Valley Project (CVP) and State Water Project (SWP). Both these
22 operational changes and other external factors such as climate and sea-level
23 changes influence the future conditions of reservoir storage, river flow, Delta
24 flows, exports, water temperature, and water quality. Evaluation of these
25 conditions is the primary focus of the physically based modeling analyses.

26 Figure 5A.A.1 shows the analytical tools applied in these assessments and the
27 relationship between these tools. Each model included in Figure 5A.A.1 provides
28 information to the subsequent model in order to provide various results to support
29 the impact analyses.

30 Changes to the historical hydrology related to the future climate are applied in the
31 CalSim II model and combined with the assumed operations for each alternative.
32 The CalSim II model simulates the operation of the major CVP and SWP
33 facilities in the Central Valley and generates estimates of river flows, exports,
34 reservoir storage, deliveries, and other parameters.

35 Agricultural and municipal and industrial deliveries resulting from CalSim II are
36 used for assessment of changes in groundwater resources and in agricultural,
37 municipal, and regional economics. Changes in land use reported by the
38 agricultural economics model are subsequently used to assess changes in air
39 quality.

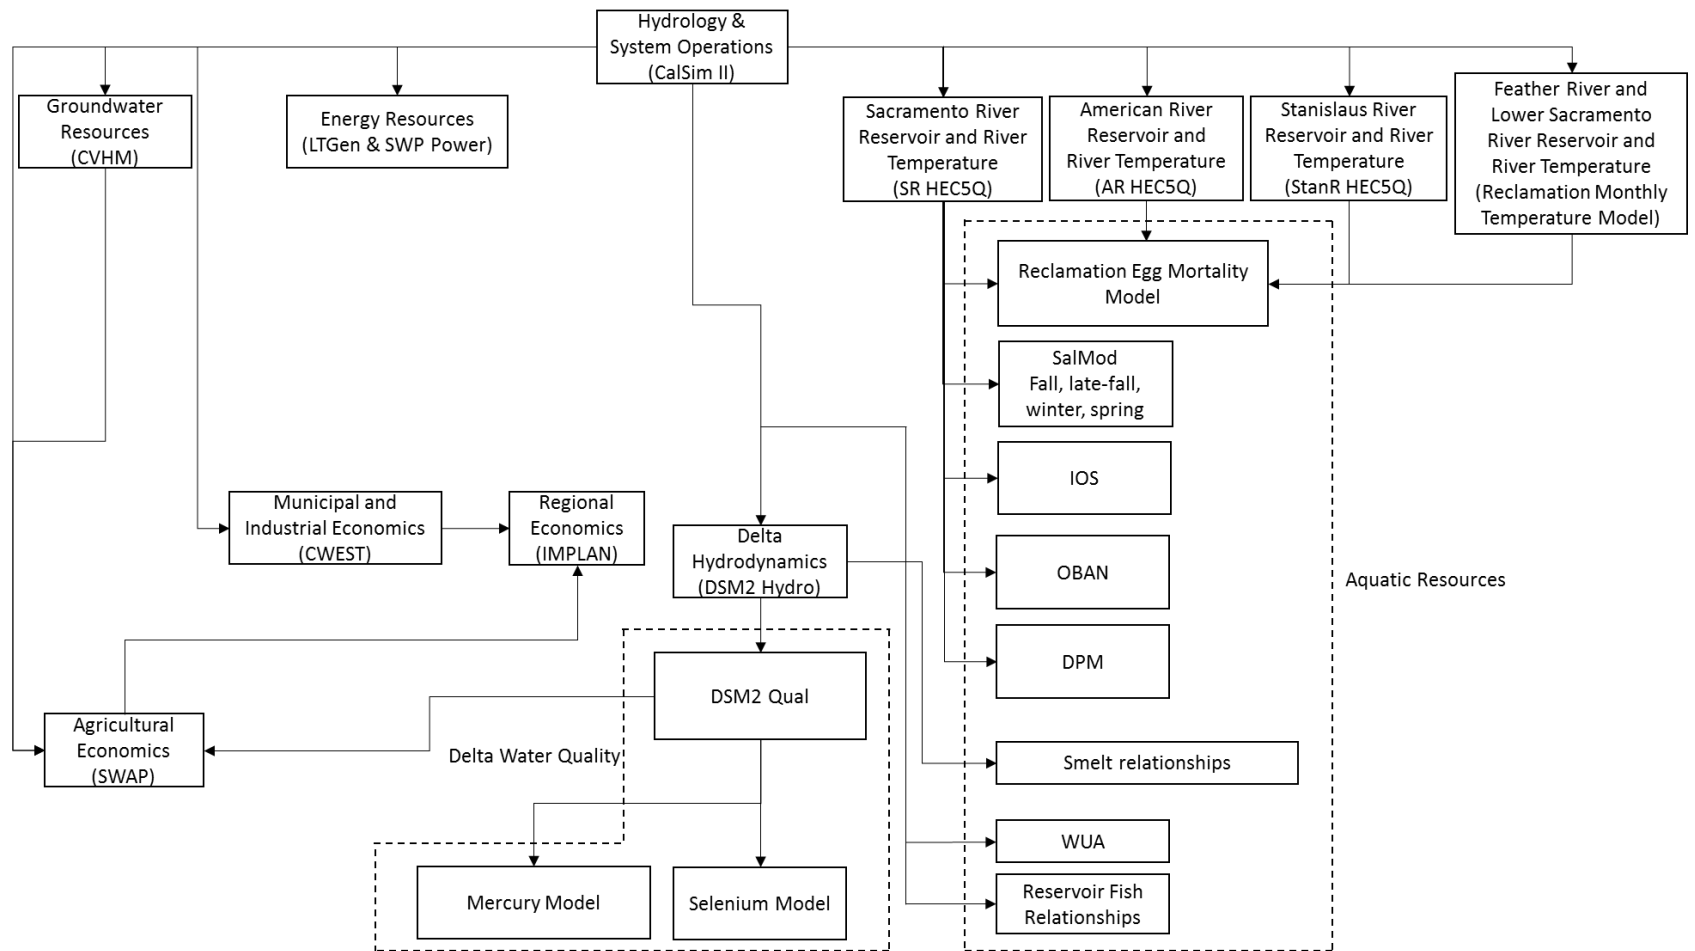

1

2 **Figure 5A.A.1 Analytical Framework Used to Evaluate Impacts of the Alternatives**

1 The Delta boundary flows and exports from CalSim II are used to drive the
2 DSM2 Delta hydrodynamic and water quality models for estimating tidally based
3 flows, stage, velocity, and salt transport within the estuary. DSM2 water quality
4 and volumetric fingerprinting results are used to assess changes in concentrations
5 of selenium and methylmercury in Delta waters.

6 Power generation models use CalSim II reservoir levels and releases to estimate
7 power use and generation capability of the projects.

8 Temperature models for the primary river systems use the CalSim II reservoir
9 storage, reservoir releases, river flows, and meteorological conditions to estimate
10 reservoir and river temperatures under each scenario.

11 Results from these temperature models are further used as an input to fisheries
12 models (e.g., SalMod, Reclamation Egg Mortality Model, and IOS) to assess
13 changes in fisheries habitat due to flow and temperature. CalSim II and DSM2
14 results are also used for fisheries models (IOS, DPM) or aquatic species
15 survival/habitat relationships developed based on peer-reviewed scientific
16 publications.

17 The results from this suite of physically based models are used to describe the
18 effects of each individual scenario considered in the EIS.

19 **5A.A.2.1 Analytical Tools**

20 A brief description of the hydrologic and hydrodynamic models discussed in
21 Chapter 5, Surface Water Resources and Water Supplies, is provided below. All
22 other subsequent models to CalSim II presented in the analytical framework are
23 described in detail in appendices of the respective chapters where their results are
24 used.

25 **5A.A.2.1.1 CalSim II**

26 The CalSim II planning model was used to simulate the coordinated operation of
27 the CVP and SWP over a range of hydrologic conditions. CalSim II is a
28 generalized reservoir-river basin simulation model that allows for specification
29 and achievement of user-specified operating rules or goals (Draper et al. 2004).
30 CalSim II represents the best available planning model for the CVP and SWP
31 system operations and has been used in previous system-wide evaluations of CVP
32 and SWP operations (Reclamation 2008a).

33 Hydrologic inputs to CalSim II include water diversion requirements (demands),
34 stream accretions and depletions, rim basin inflows, irrigation efficiencies, return
35 flows, non-recoverable losses, and groundwater operations. Sacramento Valley
36 and tributary rim basin hydrologies are developed using a process designed to
37 adjust the historical sequence of monthly stream flows over an 82-year period
38 (1922 to 2003) to represent a sequence of flows at a particular level of
39 development.

40 Adjustments to historical water supplies are determined by imposing a defined
41 level of land use on historical meteorological and hydrologic conditions. The

1 resulting hydrology represents the water supply available from Central Valley
2 streams to the CVP and SWP at that defined level of development.

3 CalSim II produces outputs for river flows and diversions, reservoir storage,
4 Delta-channel flows and exports, Delta inflow and outflow, deliveries to project
5 and non-project users, and controls on project operations. Reclamation's 2008
6 Biological Assessment on the Continued Long-term Operations of the Central
7 Valley Project and the State Water Project (2008 LTO BA) Appendix D provides
8 more information about CalSim II (Reclamation 2008a). CalSim II output
9 provides the basis for multiple other hydrologic, hydrodynamic, and biological
10 models and analyses. CalSim II results feed into other models as described
11 above.

12 **5A.A.2.1.2 Artificial Neural Network for Flow-Salinity Relationships**

13 An artificial neural network (ANN) that mimics the flow-salinity relationships as
14 modeled in DSM2 and transforms this information into a form usable by the
15 CalSim II model has been developed (Sandhu et al. 1999; Seneviratne and
16 Wu, 2007). The ANN is implemented in CalSim II to constrain the operations of
17 the upstream reservoirs and the Delta export pumps in order to satisfy particular
18 salinity requirements in the Delta. The current ANN predicts salinity at various
19 locations in the Delta using the following parameters as input: Sacramento River
20 inflow, San Joaquin River inflow, Delta Cross Channel gate position, and total
21 exports and diversions. Sacramento River inflow input accounts for Sacramento
22 River flow, Yolo Bypass flow, and combined flow from the Mokelumne,
23 Cosumnes, and Calaveras rivers (east side streams) and North Bay Aqueduct and
24 Vallejo diversions. Total exports and diversions include SWP Banks Pumping
25 Plant, CVP Tracy Pumping Plant, and Contra Costa Water District (CCWD)
26 diversions including diversion to Los Vaqueros Reservoir. The ANN model
27 approximates DSM2 model-generated salinity at the following key locations for
28 the purpose of modeling Delta water quality standards: X2, Sacramento River at
29 Emmaton, San Joaquin River at Jersey Point, Sacramento River at Collinsville,
30 and Old River at Rock Slough. In addition, the ANN is capable of providing
31 salinity estimates for Clifton Court Forebay, CCWD Alternate Intake Project, and
32 Los Vaqueros diversion locations. A more detailed description of the ANNs and
33 their use in the CalSim II model is provided in Wilbur and Munévar (2001). In
34 addition, the California Department of Water Resources (DWR) Modeling
35 Support Branch website (<http://baydeltaoffice.water.ca.gov/modeling/>) provides
36 ANN documentation.

37 **5A.A.2.1.3 DSM2**

38 DSM2 is a one-dimensional hydrodynamic and water quality simulation model
39 used to simulate hydrodynamics, water quality, and particle tracking in the
40 Sacramento-San Joaquin Delta. DSM2 represents the best available planning
41 model for Delta tidal hydraulic and salinity modeling. It is appropriate for
42 describing the existing conditions in the Delta, as well as performing simulations
43 for the assessment of incremental environmental impacts caused by future
44 facilities and operations.

1 The DSM2 model has three separate components: HYDRO, QUAL, and PTM.
2 HYDRO simulates velocities and water surface elevations and provides the flow
3 input for QUAL and PTM. DSM2-HYDRO outputs are used to predict changes
4 in flow rates and depths, and their effects on covered species, as a result of the
5 EIS and climate change.

6 The QUAL module simulates fate and transport of conservative and non-
7 conservative water quality constituents, including salts, given a flow field
8 simulated by HYDRO. Outputs are used to estimate changes in salinity, and their
9 effects on covered species, as a result of the EIS and climate change. The QUAL
10 module is also used to simulate source water fingerprinting, which allows
11 determining the relative contributions of water sources to the volume at any
12 specified location. Reclamation’s 2008 LTO BA Appendix F provides more
13 information about DSM2 (Reclamation 2008b).

14 DSM2-PTM simulates pseudo 3-D transport of neutrally buoyant particles based
15 on the flow field simulated by HYDRO. It simulates the transport and fate of
16 individual particles traveling throughout the Delta. The model uses velocity,
17 flow, and stage output from the HYDRO module to monitor the location of each
18 individual particle using assumed vertical and lateral velocity profiles and
19 specified random movement to simulate mixing. Additional information on
20 DSM2 can be found on the DWR Modeling Support Branch website at
21 <http://baydeltaoffice.water.ca.gov/modeling/>.

22 **5A.A.2.2 Key Components of the Analytical Framework**


23 Components of the EIS modeling relevant to Chapter 5, Surface Water Resources
24 and Water Supplies, are described in this appendix in separate sections, including
25 hydrology and systems operations modeling and delta hydrodynamics and water
26 quality. Each section describes in detail the key tools used for modeling, data
27 interdependencies, and limitations. It also includes descriptions of how the tools
28 are applied in a long-term planning analysis such as evaluating the alternatives
29 and describes any improvements or modifications performed for application in
30 EIS modeling.

31 Section 5A.A.3, Hydrology and Systems Operations Modeling, describes the
32 application of the CalSim II model to evaluate the effects of hydrology and
33 system operations on river flows, reservoir storage, Delta flows and exports, and
34 water deliveries. Section 5A.A.4, Delta Hydrodynamics and Water Quality,
35 describes the application of the DSM2 model to assess effects of the operations
36 considered in the EIS and resulting effects to tidal stage, velocity, flows, and
37 salinity.

38 **5A.A.2.3 Climate Change and Sea-Level Rise**

39 The modeling approach applied for the EIS integrates a suite of analytical tools in
40 a unique manner to characterize changes to the system from “atmosphere to
41 ocean.” Figure 5A.A.2 illustrates the general flow of information for
42 incorporating climate and sea-level change in the modeling analyses. Climate and
43 sea level can be considered the most upstream and most downstream boundary

1 forcings on the system analyzed in the modeling for the EIS. However, these
 2 forcings are outside the influence of the EIS and are considered external forcings.
 3 The effects of these forcings are incorporated into the key models used in the
 4 analytical framework.

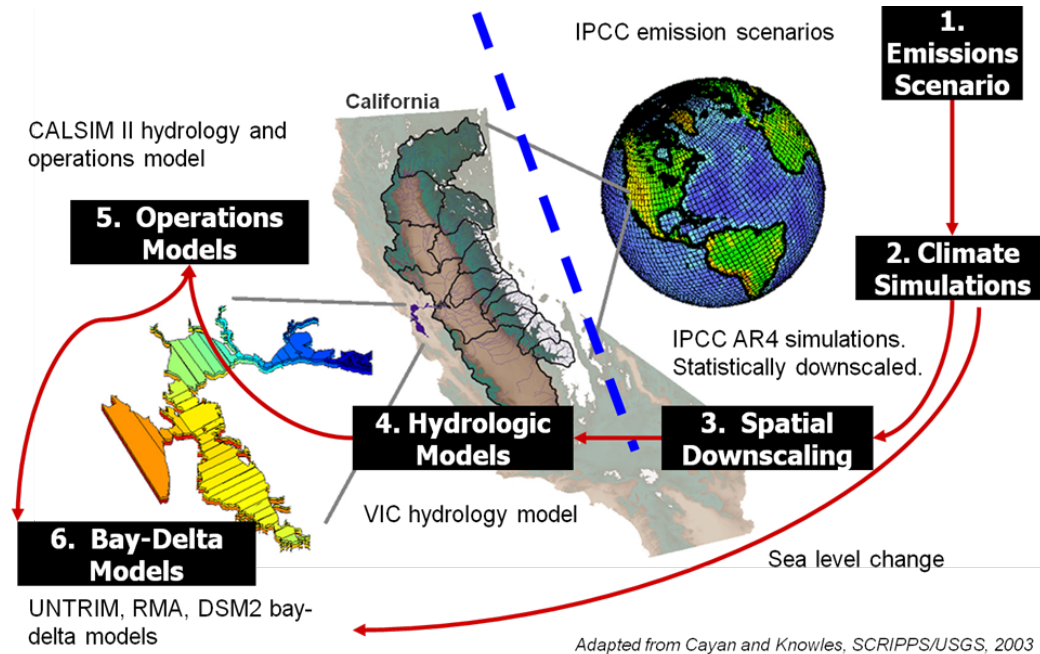

5

6 **Figure 5A.A.2 Characterizing Climate Impacts from Atmosphere to Oceans**

7 For the selected future climate scenario, regional hydrologic modeling was
 8 performed with the Variable Infiltration Capacity (VIC) hydrology model using
 9 temperature and precipitation projections of future climate. The VIC model
 10 (Liang et al. 1994; Liang et al. 1996; Nijssen et al. 1997) is a spatially distributed
 11 hydrologic model that solves the water balance at each model grid cell. The VIC
 12 model incorporates spatially distributed parameters describing topography, soils,
 13 land use, and vegetation classes. VIC is considered a macro-scale hydrologic
 14 model in that it is designed for larger basins with fairly coarse grids. In this
 15 manner, it accepts input meteorological data directly from global or national
 16 gridded databases or from general circulation model (GCM) projections. To
 17 compensate for the coarseness of the discretization, VIC is unique in its
 18 incorporation of subgrid variability to describe variations in the land parameters
 19 as well as precipitation distribution. Parameterization within VIC is performed
 20 primarily through adjustments to parameters describing the rates of infiltration
 21 and baseflow as a function of soil properties, as well as the soil layers depths.
 22 When simulating in water balance mode, as done for this California application,
 23 VIC is driven by daily inputs of precipitation, maximum and minimum
 24 temperature, and windspeed. The model internally calculates additional
 25 meteorological forcings such short-wave and long-wave radiation, relative
 26 humidity, vapor pressure and vapor pressure deficits. Rainfall, snow, infiltration,
 27 evapotranspiration, runoff, soil moisture, and baseflow are computed over each
 28 grid cell on a daily basis for the entire period of simulation. An offline routing

1 tool then processes the individual cell runoff and baseflow terms and routes the
2 flow to develop streamflow at various locations in the watershed.
3 In addition to a range of hydrologic process information, the VIC model generates
4 natural stream flows under each assumed climate condition (DWR et al. 2013).
5 Section 5A.A.5 provides more detailed information on climate change and sea-
6 level rise modeling approach followed for the EIS.

7 **5A.A.3 Hydrology and System Operations**

8 The hydrology of the Central Valley and coordinated operation of the CVP and
9 SWP systems is a critical element in any assessment of changed conditions in the
10 Central Valley and the Delta. Changes to conveyance, flow patterns, demands,
11 regulations, or Delta configuration will influence the operations of the CVP and
12 SWP reservoirs and export facilities. The operations of these facilities, in turn,
13 influence Delta flows, water quality, river flows, and reservoir storage. The
14 interaction between hydrology, operations, and regulations is not always intuitive
15 and detailed analysis of this interaction often results in new understanding of
16 system responses. Modeling tools are required to approximate these complex
17 interactions under future conditions.

18 This section describes in detail the use of CalSim II and the methodology used to
19 simulate hydrology and system operations for evaluating the effects of the EIS.


20 **5A.A.3.1 CalSim II**

21 The CalSim II planning model was used to simulate the operation of the CVP and
22 SWP over a range of regulatory conditions. CalSim II incorporates major CVP
23 and SWP facilities as well as key local (or non-project) facilities. A list of major
24 modeled facilities is located in Table 5A.B.20.

25 The CalSim II simulation model uses single time-step optimization techniques to
26 route water through a network of storage nodes and flow arcs based on a series of
27 user-specified relative priorities for water allocation and storage. Physical
28 capacities and specific regulatory and contractual requirements are input as linear
29 constraints to the system operation using the water resources simulation language
30 (WRESL). The process of conveying water through the channels and storing
31 water in reservoirs is performed by a mixed-integer linear-programming solver.
32 For each time step, the solver maximizes the objective function to determine a
33 solution that delivers or stores water according to the specified priorities and
34 satisfies all system constraints. The sequence of solved linear-programming
35 problems represents the simulation of the system over the period of analysis.

36 CalSim II includes an 82-year modified historical hydrology (water years
37 1922-2003) developed jointly by Reclamation and DWR. Water diversion
38 requirements (demands), stream accretions and depletions, rim basin inflows,
39 irrigation efficiencies, return flows, nonrecoverable losses, and groundwater
40 operations are components that make up the hydrology used in CalSim II.
41 Sacramento Valley and tributary rim basin hydrologies are developed using a

1 process designed to adjust the historical observed sequence of monthly stream
 2 flows to represent a sequence of flows at a future level of development.
 3 Adjustments to historic water supplies are determined by imposing future level
 4 land use on historical meteorological and hydrologic conditions. The resulting
 5 hydrology represents the water supply available from Central Valley streams to
 6 the system at a future level of development. Figure 5A.A.3 shows the valley floor
 7 depletion regions, which represent the spatial resolution at which the hydrologic
 8 analysis is performed in the model.

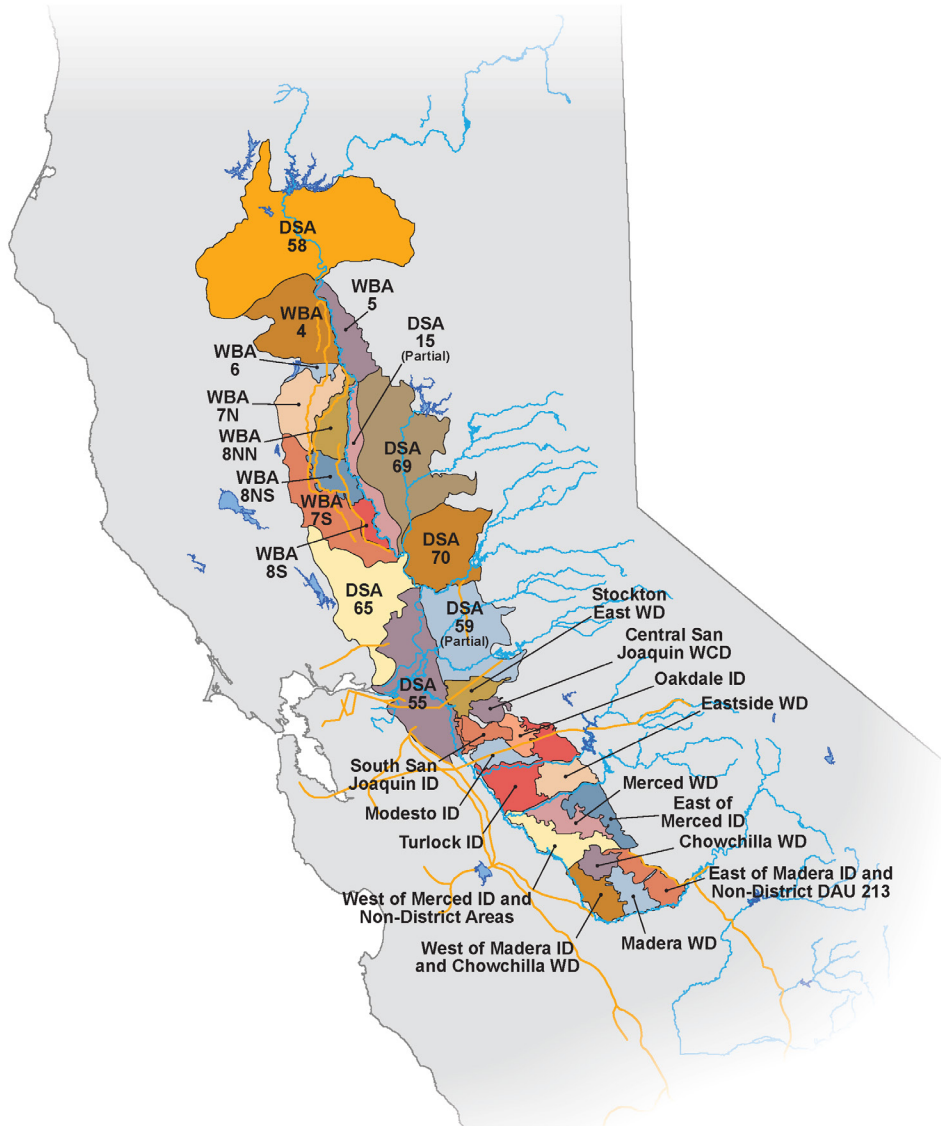

9
 10 **Figure 5A.A.3 CalSim II Depletion Analysis Regions**

11 CalSim II uses rule-based algorithms for determining deliveries to north-of-Delta
 12 and south-of-Delta CVP and SWP contractors. This delivery logic uses runoff
 13 forecast information, which incorporates uncertainty and standardized rule curves.
 14 The rule curves relate storage levels and forecasted water supplies to project

1 delivery capability for the upcoming year. The delivery capability is then
2 translated into CVP and SWP contractor allocations that are satisfied through
3 coordinated reservoir-export operations.

4 The CalSim II model utilizes a monthly time step to route flows throughout the
5 river-reservoir system of the Central Valley. Although monthly time steps are
6 reasonable for long-term planning analyses of water operations, a component of
7 the EIS conveyance and conservation strategy includes operations that are
8 sensitive to flow variability at scales less than monthly (i.e., the operation of the
9 Fremont Weir). Initial comparisons of monthly versus daily operations at these
10 facilities indicated that weir spills were likely underestimated and diversion
11 potential was likely overstated using a monthly time step. For these reasons, a
12 monthly to daily flow disaggregation technique was included in the CalSim II
13 model for the Fremont Weir and the Sacramento Weir. The technique applies
14 historical daily patterns, based on the hydrology of the year, to transform the
15 monthly volumes into daily flows. Reclamation's 2008 LTO BA Appendix D
16 provides more information about CalSim II (Reclamation 2008a).

17 **5A.A.3.2 Artificial Neural Network for Flow-Salinity Relationship**

18 Determination of flow-salinity relationships in the Sacramento-San Joaquin Delta
19 is critical to both project and ecosystem management. Operation of the CVP and
20 SWP facilities and management of Delta flows is often dependent on Delta flow
21 needs for salinity standards. Salinity in the Delta cannot be simulated accurately
22 by the simple mass-balance routing and coarse time step used in CalSim II.
23 Likewise, the upstream reservoirs and operational constraints cannot be modeled
24 in the DSM2 model. An ANN has been developed (Sandhu et al. 1999) that
25 attempts to mimic the flow-salinity relationships as simulated in DSM2, but
26 provide a rapid transformation of this information into a form usable by the
27 CalSim II operations model. The ANN is implemented in CalSim II to constrain
28 the operations of the upstream reservoirs and the Delta export pumps in order to
29 satisfy particular salinity requirements. A more detailed description of the use of
30 ANNs in the CalSim II model is provided in Wilbur and Munévar (2001).

31 The ANN developed by DWR (Sandhu et al. 1999, Seneviratne and Wu 2007)
32 attempts to statistically correlate the salinity results from a particular DSM2
33 model run to the various peripheral flows (Delta inflows, exports, and diversions),
34 gate operations, and an indicator of tidal energy. The ANN is calibrated or
35 trained on DSM2 results that may represent historical or future conditions using a
36 full-circle analysis (Seneviratne and Wu 2007). For example, a future
37 reconfiguration of the Delta channels to improve conveyance may significantly
38 affect the hydrodynamics of the system. The ANN would be able to represent this
39 new configuration by being retrained on DSM2 model results that included the
40 new configuration.

41 The current ANN predicts salinity at various locations in the Delta using the
42 following parameters as input: Northern flows, San Joaquin River inflow, Delta
43 Cross Channel gate position, total exports and diversions, Net Delta Consumptive
44 Use (an indicator of the tidal energy), and San Joaquin River at Vernalis salinity.

1 Northern flows include Sacramento River flow, Yolo Bypass flow, and combined
2 flow from the Mokelumne, Cosumnes, and Calaveras rivers (East Side Streams)
3 minus North Bay Aqueduct and Vallejo exports. Total exports and diversions
4 include SWP Banks Pumping Plant, CVP Jones Pumping Plant, and CCWD
5 diversions, including diversions to Los Vaqueros Reservoir. A total of 148 days
6 of values for each of these parameters is included in the correlation, representing
7 an estimate of the length of memory of antecedent conditions in the Delta. The
8 ANN model approximates DSM2 model-generated salinity at the following key
9 locations for the purpose of modeling Delta water quality standards: X2,
10 Sacramento River at Emmaton, San Joaquin River at Jersey Point, Sacramento
11 River at Collinsville, and Old River at Rock Slough. In addition, the ANN is
12 capable of providing salinity estimates for Clifton Court Forebay, and the CCWD
13 Alternate Intake Project and Los Vaqueros diversion locations.

14 The ANN may not fully capture the dynamics of the Delta under conditions other
15 than those for which it was trained. It is possible that the ANN will exhibit errors
16 in flow regimes beyond those for which it was trained. Therefore, a new ANN is
17 needed for any new Delta configuration or under sea-level rise conditions that
18 may result in changed flow-salinity relationships in the Delta.

19 **5A.A.3.3 Application of CalSim II to Evaluate EIS Alternatives**

20 Typical long-term planning analyses of the Central Valley system and operations
21 of the CVP and SWP have applied the CalSim II model to analyze system
22 responses. CalSim II simulates future CVP and SWP project operations based on
23 an 82-year monthly hydrology derived from the observed 1922-2003 period.
24 Future land use and demands are projected for the appropriate future period. The
25 system configuration of facilities, operations, and regulations forms the input to
26 the model and defines the limits or preferences for operation. The configuration
27 of the Delta, while not simulated directly in CalSim II, informs the flow-salinity
28 relationships and several flow-related regressions for interior Delta conditions
29 (e.g., X2 and OMR) included in the model. The CalSim II model is simulated for
30 each set of hydrologic, facility, operations, regulations, and Delta configuration
31 conditions. Some refinement of the CVP and SWP operations related to delivery
32 allocations and San Luis target storage levels are generally necessary to have the
33 model reflect suitable north-south reservoir balancing under future conditions.
34 These refinements are generally made by experienced modelers in coordination
35 with project operators.

36 The CalSim II model produces outputs of river flows, exports, water deliveries,
37 reservoir storage, water quality, and several derived variables such as X2, Delta
38 salinity, OMR (combined Old and Middle River flows), and QWEST (westerly
39 flow on the San Joaquin River past Jersey Point). The CalSim II model is most
40 appropriately applied for comparing one alternative to another and drawing
41 comparisons among the results. This is the method applied for the EIS.

42 The No Action Alternative simulation assumes continuation of operations under
43 the current regulatory environment with existing facilities for future climate and
44 sea-level conditions (projected to the Year 2030).

1 The Second Basis of Comparison is developed due to the identified need during
 2 scoping comments for a basis of comparison to operations that would occur
 3 “without” the reasonable and prudent alternatives (RPAs). The Second Basis of
 4 Comparison assumptions do not include most of the RPAs. The Second Basis of
 5 Comparison does, however, include actions that are constructed (e.g., Red Bluff
 6 Pumping Plant), implemented (e.g., the Suisun Marsh Habitat Management,
 7 Preservation, and Restoration Plan), legislatively mandated (e.g., the San Joaquin
 8 River Restoration Plan), and have made substantial progress (e.g., Yolo Bypass
 9 Salmonid Habitat Restoration and Fish Passage).

10 Each alternative is compared to the No Action Alternative and the Second Basis
 11 of Comparison to evaluate areas in which the project changes conditions and the
 12 seasonality and magnitude of such changes. The change in hydrologic response or
 13 system conditions is important information that informs the impact analysis
 14 related to water-dependent resources in Sacramento-San Joaquin watersheds.

15 **5A.A.3.3.1 ANN Retraining**

16 ANNs are used for simulating flow-salinity relationships in CalSim II. They are
 17 trained on DSM2 outputs and therefore emulate DSM2 results. ANN requires
 18 retraining whenever the flow-salinity relationship in the Delta changes. As
 19 mentioned earlier, EIS analysis assumes a 15-cm sea-level rise. An ANN
 20 developed to simulate salinity conditions with 15-cm sea-level rise was developed
 21 by and obtained from DWR. The ANN retraining process is described in
 22 Section 5A.A.4.3.1.

23 **5A.A.3.3.2 Incorporation of Climate Change**

24 Climate and sea level change are incorporated into the CalSim II model in two
 25 ways: changes to the input hydrology and changes to the flow-salinity relationship
 26 in the Delta due to sea-level rise. In this approach, changes in runoff and stream
 27 flow are simulated through VIC modeling under representative climate scenarios.
 28 These simulated changes in runoff are applied to the CalSim II inflows as a
 29 fractional change from the observed inflow patterns (simulated future runoff
 30 divided by historical runoff). These fraction changes are first applied for every
 31 month of the 82-year period consistent with the VIC simulated patterns. A second
 32 order correction is then applied to ensure that the annual shifts in runoff at each
 33 location are consistent with that generated from the VIC modeling. A spreadsheet
 34 tool has been prepared to process this information and generate adjusted inflow
 35 time series records for CalSim II. Once the changes in flows have been resolved,
 36 water year types and other hydrologic indices that govern water operations or
 37 compliance are adjusted to be consistent with the new hydrologic regime. This
 38 spreadsheet tool has been updated for the EIS analysis to accommodate the needs
 39 of the CalSim II version used in this study.

40 The effect of sea-level rise on the flow-salinity response is incorporated in the
 41 respective ANN.

42 The following input parameters are adjusted in CalSim II to incorporate the
 43 effects of climate change:

- 1 • Inflow time series records for all major streams in the Central Valley
- 2 • Sacramento and San Joaquin valley water year types
- 3 • Runoff forecasts used for reservoir operations and allocation decisions
- 4 • Delta water temperature as used in triggering Biological Opinion Smelt
- 5 criteria
- 6 • A modified ANN to reflect the flow-salinity response under 15-cm sea-level
- 7 change

8 Section 5A.A.5 provides more detailed information on climate change and sea-
 9 level rise modeling approaches followed for the EIS.

10 The CalSim II simulations do not consider future climate change adaptations that
 11 may manage the CVP and SWP system in a different manner than today to reduce
 12 climate impacts. For example, future changes in reservoir flood control
 13 reservation to better accommodate a seasonally changing hydrograph may be
 14 considered under future programs, but are not considered under the EIS. Thus,
 15 the CalSim II EIS results represent the risks to operations, water users, and the
 16 environment in the absence of dynamic adaptation for climate change.

17 **5A.A.3.4 Output Parameters**

18 The hydrology and system operations models produce the following key
 19 parameters on a monthly time step:

- 20 • River flows and diversions
- 21 • Reservoir storage
- 22 • Delta flows and exports
- 23 • Delta inflow and outflow
- 24 • Deliveries to project and non-project users
- 25 • Controls on project operations

26 Some operations have been informed by the daily variability included in the
 27 CalSim II model for the EIS and, where appropriate, these results are presented.
 28 However, it should be noted that CalSim II remains a monthly model. The daily
 29 variability inputs to the CalSim II model help to better represent certain
 30 operational aspects, but the monthly results are utilized for water balance.

31 **5A.A.3.5 Appropriate Use of CalSim II Results**

32 CalSim II is a monthly model developed for planning level analyses. The model
 33 is run for an 82-year historical hydrologic period, at a projected level of
 34 hydrology and demands, and under an assumed framework of regulations.
 35 Therefore, the 82-year simulation does not provide information about historical
 36 conditions, but it does provide information about variability of conditions that
 37 would occur at the assumed level of hydrology and demand with the assumed
 38 operations, under the same historical hydrologic sequence. Because it is not a
 39 physically based model, CalSim II is not calibrated and cannot be used in a

1 predictive manner. CalSim II is intended to be used in a comparative manner,
2 which is appropriate for a NEPA analysis.

3 In CalSim II, operational decisions are made on a monthly basis, based on a set of
4 predefined rules that represent the assumed regulations. The model has no
5 capability to adjust these rules based on a sequence of hydrologic events such as a
6 prolonged drought, or based on statistical performance criteria such as meeting a
7 storage target in an assumed percentage of years.

8 Although there are certain components in the model that are downscaled to daily
9 time step (simulated or approximated hydrology) such as an air-temperature-
10 based trigger for a fisheries action, the results of those daily conditions are always
11 averaged to a monthly time step (for example, a certain number of days with and
12 without the action is calculated and the monthly result is calculated using a day-
13 weighted average based on the total number of days in that month), and
14 operational decisions based on those components are made on a monthly basis.
15 Therefore, reporting sub-monthly results from CalSim II or from any other
16 subsequent model that uses monthly CalSim results as an input is not considered
17 an appropriate use of model results.

18 Appropriate use of model results is important. Despite detailed model inputs and
19 assumptions, the CalSim II results may differ from real-time operations under
20 stressed water supply conditions. Such model results occur due to the inability of
21 the model to make real-time policy decisions under extreme circumstances, as the
22 actual (human) operators must do. Therefore, these results should only be
23 considered an indicator of stressed water supply conditions under that alternative,
24 and should not be considered to reflect what would occur in the future. For
25 example, reductions to senior water rights holders due to dead-pool conditions in
26 the model can be observed in model results under certain circumstances. These
27 reductions, in real-time operations, may be avoided by making policy decisions
28 on other requirements in prior months. In actual future operations, as has always
29 been the case in the past, the project operators would work in real time to satisfy
30 legal and contractual obligations given the current conditions and hydrologic
31 constraints. Chapter 5, Surface Water Resources and Water Supplies, provides
32 appropriate interpretation and analysis of such model results. Section 5.3.3 of
33 Chapter 5, describes historical responses by CVP and SWP to recent drought
34 conditions.

35 Reclamation's 2008 LTO BA Appendix W (Reclamation 2008c) included a
36 comprehensive sensitivity and uncertainty analysis of CalSim II results relative to
37 the uncertainty in the inputs. This appendix provides a good summary of the key
38 inputs that are critical to the largest changes in several operational outputs.
39 Understanding the findings from this appendix may help in better understanding
40 the alternatives.

41 **5A.A.3.6 Linkages to Other Models**

42 The hydrology and system operations models generally require input assumptions
43 relating to hydrology, demands, regulations, and flow-salinity responses.
44 Reclamation and DWR have prepared hydrologic inputs and demand assumptions

1 for a future (2030) level of development (future land use and development
2 assumptions) based on historical hydroclimatic conditions. Regulations and
3 associated operations are translated into operational requirements. The flow-
4 salinity ANN, representing appropriate sea-level rise, is embedded into the system
5 operations model.

6 As mentioned previously in this appendix, changes to the historical hydrology
7 related to future climate are applied in the CalSim II model and combined with
8 the assumed operations for each alternative. The CalSim II model simulates the
9 operation of the major CVP and SWP facilities in the Central Valley and
10 generates estimates of river flows, exports, reservoir storage, deliveries, and other
11 parameters.

12 Agricultural and municipal and industrial deliveries resulting from CalSim II are
13 used in other models for assessing changes to groundwater resources and
14 agricultural, municipal, and regional economics. Changes in land use reported by
15 the agricultural economics model are subsequently used to assess changes in air
16 quality.

17 The Delta boundary flows and exports from CalSim II are then used to drive the
18 DSM2 Delta hydrodynamic and water quality models for estimating tidally based
19 flows, stage, velocity, and salt transport within the estuary. DSM2 water quality
20 and volumetric fingerprinting results are used to assess changes in concentration
21 of selenium and methylmercury in Delta waters.

22 Power generation models use CalSim II reservoir levels and releases to estimate
23 power use and generation capability of the projects.

24 River and temperature models for the primary river systems use the CalSim II
25 reservoir storage, reservoir releases, river flows, and meteorological conditions to
26 estimate reservoir and river temperatures under each scenario.

27 Results from these temperature models are further used as an input to fisheries
28 models (e.g., SalMod, Reclamation Egg Mortality Model, and IOS) to assess
29 changes in fisheries habitat due to flow and temperature. CalSim II and DSM2
30 results are also used for fisheries models (IOS, DPM) or aquatic species
31 survival/habitat relationships developed based on peer-reviewed scientific
32 publications.

33 The results from this suite of physically based models are used to describe the
34 effects of each individual scenario considered in the EIS.

35 **5A.A.4 Delta Hydrodynamics and Water Quality**

36 Hydrodynamics and water quality modeling is essential to understanding the
37 impacts of operation of the CVP and SWP on the Delta. The analysis of the
38 hydrodynamics and water quality changes as a result of operational changes is
39 critical in understanding the impacts on the habitats, species, and water users that
40 depend on the Delta.

1 This section describes the methodology used for simulating Delta hydrodynamics
2 and water quality for evaluating the alternatives. It discusses the primary tool
3 (DSM2) used in this process.

4 **5A.A.4.1 Overview of Hydrodynamics and Water Quality Modeling** 5 **Approach**

6 There are several tools available to simulate hydrodynamics and water quality in
7 the Delta. Some tools simulate detailed processes, but are computationally
8 intensive and have long runtimes. Other tools approximate certain processes and
9 have short runtimes, while only compromising slightly on the accuracy of the
10 results. For a planning analysis, it is ideal to understand the resulting changes over
11 several years to cover a range of hydrologic conditions. So, a tool that can
12 simulate the changed hydrodynamics and water quality in the Delta accurately
13 with a short runtime is desired. DSM2 is a one-dimensional hydrodynamics and
14 water quality model that serves this purpose.

15 DSM2 has a limited ability to simulate two-dimensional features such as tidal
16 marshes and three-dimensional processes such as gravitational circulation, which
17 is known to increase with sea-level rise in the estuaries. Therefore, it must be
18 recalibrated or corroborated based on a data set that accurately represents the
19 conditions in the Delta under sea-level rise. Because the proposed conditions are
20 hypothetical, the best available approach to estimate the Delta hydrodynamics is
21 to simulate higher dimensional models that can resolve the two- and three-
22 dimensional processes well. These models would generate the data sets needed to
23 corroborate or recalibrate DSM2 under those conditions so that it can simulate the
24 hydrodynamics and salinity transport with reasonable accuracy. For the purposes
25 of this EIS, a DSM2 model that was corroborated for 15-cm sea-level rise is used.

26 **5A.A.4.2 Delta Simulation Model**

27 DSM2 is a one-dimensional hydrodynamics, water quality, and particle-tracking
28 simulation model used to simulate hydrodynamics, water quality, and particle
29 tracking in the Sacramento-San Joaquin Delta (Anderson and Mierzwa 2002).
30 DSM2 represents the best available planning model for Delta tidal hydraulics and
31 salinity modeling. It is appropriate for describing the existing conditions in the
32 Delta, as well as performing simulations for the assessment of incremental
33 environmental impacts caused by future facilities and operations. The DSM2
34 model has three separate components: HYDRO, QUAL, and PTM. HYDRO
35 simulates one-dimensional hydrodynamics including flows, velocities, depth, and
36 water surface elevations. HYDRO provides the flow input for QUAL and PTM.
37 QUAL simulates one-dimensional fate and transport of conservative and non-
38 conservative water quality constituents given a flow field simulated by HYDRO.
39 PTM simulates pseudo 3-D transport of neutrally buoyant particles based on the
40 flow field simulated by HYDRO.

41 DSM2 v8.0.6 was used in modeling of the EIS No Action Alternative, Second
42 Basis of Comparison, and the other alternatives using a period of simulation
43 consistent with the CalSim II model (water years 1922 to 2003).

1 DSM2 hydrodynamics and salinity (electrical conductivity, or EC) were initially
2 calibrated in 1997 (DWR 1997). In 2000, a group of agencies, water users, and
3 stakeholders recalibrated and validated DSM2 in an open process resulting in a
4 model that could replicate the observed data more closely than the 1997 version
5 (DSM2PWT 2001). In 2009, DWR performed a calibration and validation of
6 DSM2 by including the flooded Liberty Island in the DSM2 grid, which allowed
7 for an improved simulation of tidal hydraulics and EC transport in DSM2
8 (DWR 2009). The model used for evaluating the EIS scenarios was based on this
9 latest calibration.

10 Simulation of dissolved organic carbon (DOC) transport in DSM2 was
11 successfully validated in 2001 by DWR (Pandey 2001). The temperature and
12 dissolved oxygen (DO) calibration was initially performed in 2003 by DWR
13 (Rajbhandari 2003). Recent development efforts by Resource Management
14 Associates, Inc. (RMA) in 2009 allowed for improved calibration of temperature,
15 DO, and the nutrient transport in DSM2.

16 **5A.A.4.2.1 DSM2-HYDRO**

17 The HYDRO module is a one-dimensional, implicit, unsteady, open-channel flow
18 model that DWR developed from FOURPT, a four-point finite difference model
19 originally developed by the U.S. Geological Survey (USGS) in Reston, Virginia.
20 DWR adapted the model to the Delta by revising the input-output system,
21 including open-water elements, and incorporating water project facilities, such as
22 gates, barriers, and the Clifton Court Forebay. HYDRO simulates water surface
23 elevations, velocities, and flows in the Delta channels (Nader-Tehrani 1998).
24 HYDRO provides the flow input necessary for QUAL and PTM modules.

25 The HYDRO module solves the continuity and momentum equations using a fully
26 implicit scheme. These partial differential equations are solved using a finite
27 difference scheme requiring four points of computation. The equations are
28 integrated in time and space, which leads to a solution of stage and flow at the
29 computational points. HYDRO enforces an “equal stage” boundary condition for
30 all the channels connected to a junction. The model can handle both irregular
31 cross-sections derived from the bathymetric surveys and trapezoidal cross-
32 sections. Even though, the model formulation includes a baroclinic term, the
33 density is generally held constant in the HYDRO simulations.

34 HYDRO allows the simulation of hydraulic gates in the channels. A gate may
35 have several associated hydraulic features (e.g., radial gates, flash boards, and
36 boat ramps), each of which may be operated independently to control flow. Gates
37 can be placed either at the upstream or downstream end of a channel. Once the
38 location of a gate is defined, the boundary condition for the gated channel is
39 modified from “equal stage” to “known flow,” with the calculated flow. The
40 gates can be opened or closed in one or both directions by specifying a coefficient
41 of zero or one.

42 Reservoirs are used to represent open bodies of water that store flow. Reservoirs
43 are treated as vertical-walled tanks in DSM2, with a known surface area and
44 bottom elevation and are considered instantly well-mixed. The flow interaction

1 between the open water area and one or more of the connecting channels is
2 determined using the general orifice formula. The flow in and out of the reservoir
3 is controlled using the flow coefficient in the orifice equation, which can be
4 different in each direction. DSM2 does not allow the cross-sectional area of the
5 inlet to vary with the water level.

6 DSM2 v8 includes a new feature called “operating rules” under which the gate
7 operations or the flow boundaries can be modified dynamically when the model is
8 running based on the current value of a state variable (flow, stage, or velocity).
9 The change can also be triggered based on a time series that is not currently
10 simulated in the model (e.g., daily averaged EC) or based on the current time step
11 of the simulation (for example, a change can occur at the end of the day or end of
12 the season). The operating rules include many functions that allow derivation of
13 the quantities to be used as trigger from the model data or outside time series data.
14 Operating rules allow a change or an action to occur when the trigger value
15 changes from false to true.

16 **5A.A.4.2.2 DSM2-QUAL**

17 The QUAL module is a one-dimensional water quality transport model that DWR
18 adapted from the Branched Lagrangian Transport Model originally developed by
19 the USGS. DWR added many enhancements to the QUAL module, such as open
20 water areas and gates. A Lagrangian feature in the formulation eliminates the
21 numerical dispersion that is inherently in other segmented formulations, although
22 the tidal dispersion coefficients must still be specified. QUAL simulates fate and
23 transport of conservative and nonconservative water quality constituents given a
24 flow field simulated by HYDRO. It can calculate mass transport processes for
25 conservative and nonconservative constituents including salts, water temperature,
26 nutrients, DO, and trihalomethane formation potential.


27 The main processes contributing to the fate and transport of the constituents
28 include flow-dependent advection and tidal dispersion in the longitudinal
29 direction. Mass-balance equations are solved for all quality constituents in each
30 parcel of water using the tidal flows and volumes calculated by the HYDRO
31 module. Additional information and the equations used are specified in the
32 19th annual progress report by DWR (Rajbhandari 1998).

33 The QUAL module is also used to simulate source water fingerprinting, which
34 allows determining the relative contributions of water sources to the volume at
35 any specified location. It is also used to simulate constituent fingerprinting,
36 which determines the relative contributions of conservative constituent sources to
37 the concentration at any specified location. For fingerprinting studies, six main
38 sources are typically tracked: Sacramento River, San Joaquin River, Martinez,
39 Eastside Streams (Mokelumne, Cosumnes and Calaveras combined), agricultural
40 drains (all combined), and Yolo Bypass. For source water fingerprinting, a tracer
41 with constant concentration is assumed for each source tracked, while the
42 concentrations at other inflows are kept as zero. For constituent (e.g., EC)
43 fingerprinting analysis, the concentrations of the desired constituent are specified

1 at each tracked source, while the concentrations at other inflows are kept as zero
 2 (Anderson 2003).

3 **5A.A.4.2.3 DSM2 Input Requirements**

4 DSM2 requires input assumptions relating to physical description of the system
 5 (e.g., Delta channel, marsh, and island configuration); description of flow control
 6 structures such as gates; initial estimates for stage, flow, and EC throughout the
 7 Delta; and time-varying input for all boundary river flows and exports, tidal
 8 boundary conditions, gate operations, and constituent concentrations at each
 9 inflow. Figure 5A.A.4 illustrates the hydrodynamic and water quality boundary
 10 conditions required in DSM2. For long-term planning simulations, output from
 11 the CalSim II model generally provides the necessary input for the river flows and
 12 exports.

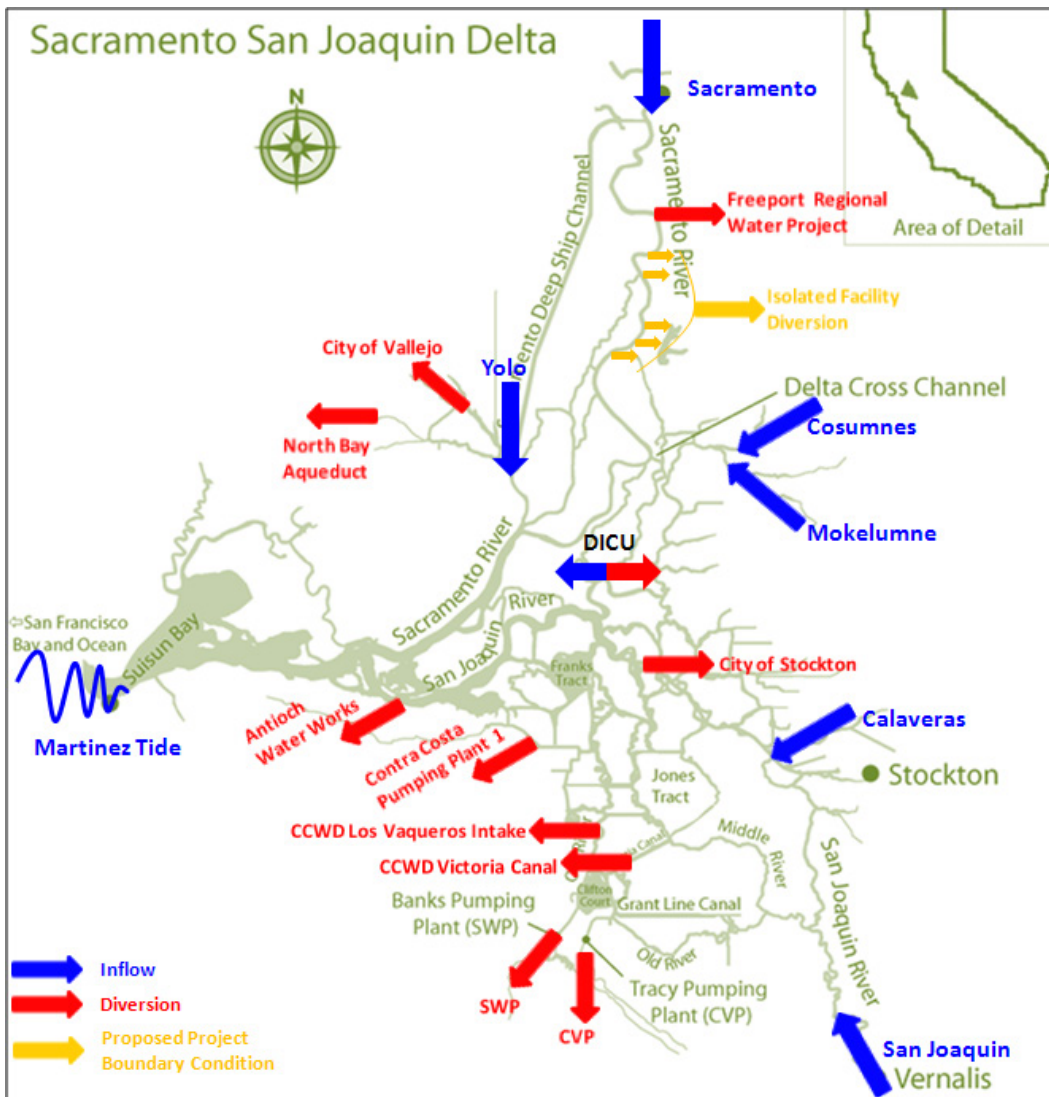

13

14 **Figure 5A.A.4 Hydrodynamic and Water Quality Boundary Conditions in DSM2**

1 Assumptions relating to Delta configuration and gate operations are directly input
 2 into the hydrodynamic models. Adjusted astronomical tide (Ateljevich 2001a)
 3 normalized for sea-level rise (Ateljevich and Yu 2007) is forced at the Martinez
 4 boundary. Constituent concentrations are specified at the inflow boundaries,
 5 which are estimated from either historical information or CalSim II results. The
 6 EC boundary condition at Vernalis is derived from the CalSim II results. The
 7 Martinez EC boundary condition is derived based on the simulated net Delta
 8 outflow from CalSim II and using a modified G-model (Ateljevich 2001b).

9 The major hydrodynamic boundary conditions are listed in Table 5A.A.1, and the
 10 locations at which constituent concentrations are specified for the water quality
 11 model are listed in Table 5A.A.2.

12 **Table 5A.A.1 DSM2 HYDRO Boundary Conditions**

Boundary Condition	Location/Control Structure	Typical Temporal Resolution
Tide	Martinez	15 minutes
Delta Inflows	Sacramento River at Freeport	1 day
	San Joaquin River at Vernalis	1 day
	Eastside Streams (Mokelumne and Cosumnes Rivers)	1 day
	Calaveras River	1 day
	Yolo Bypass	1 day
Delta Exports/Diversions	Banks Pumping Plant (SWP)	1 day
	Jones Pumping Plant (CVP)	1 day
	Contra Costa Water District Diversions at Rock Slough, Old River at Highway 4 and Victoria Canal	1 day
	North Bay Aqueduct	1 day
	City of Vallejo	1 day
	Antioch Water Works	1 day
	Freeport Regional Water Project	1 day
	City of Stockton	1 day
	Isolated Facility Diversion	1 day
Delta Island Consumptive Use	Diversion	1 month
	Seepage	1 month
	Drainage	1 month
Gate Operations	Delta Cross Channel	Irregular time series

Gate Operations (continued)	South Delta Temporary Barriers	Dynamically operated on 15-minute step
	Montezuma Salinity Control Gate	Dynamically operated on 15-minute step

1 **Table 5A.A.2 DSM2 QUAL Boundary Conditions Typically Used in a Salinity**
 2 **Simulation**

Boundary Condition	Location/Control Structure	Typical Temporal Resolution
Ocean Salinity	Martinez	15 minutes
Delta Inflows	Sacramento River at Freeport	Constant
	San Joaquin River at Vernalis	1 month
	Eastside Streams (Mokelumne and Cosumnes Rivers)	Constant
	Calaveras River	Constant
	Yolo Bypass	Constant
Delta Island Consumptive Use	Drainage	1 month (repeated each year)

3 Note: For other water quality constituents, concentrations are required at the same
 4 locations.

5 **5A.A.4.3 Application of DSM2 to Evaluate EIS Alternatives**

6 For EIS purposes, DSM2 was run for the 82-year period from water year 1922 to
 7 water year 2003 consistent with CalSim II, on a 15-minute time step. Inputs
 8 needed for DSM2—inflows, exports, and Delta Cross Channel (DCC) gate
 9 operations—were provided by the 82-year CalSim II simulations. The tidal
 10 boundary condition at Martinez was provided by an adjusted astronomical tide
 11 (Ateljevich and Yu 2007). Monthly Delta channel depletions (i.e., diversions,
 12 seepage, and drainage) were estimated using DWR’s Delta Island Consumptive
 13 Use model (Mahadevan 1995).

14 CalSim II provides monthly inflows and exports in the Delta. Traditionally, the
 15 Sacramento and San Joaquin river inflows are disaggregated to a daily time step
 16 for use in DSM2, either by applying rational histosplines or by assuming that the
 17 monthly average flow is constant over the whole month. The splines allow a
 18 smooth transition between the months. The smoothing reduces sharp transitions
 19 at the start of the month, but still results in constant flows for most of the month.
 20 Other inflows, exports, and diversions were assumed to be constant over the
 21 month.

1 DCC gate operation input in DSM2 is based on CalSim II output. For each
 2 month, DSM2 assumes the DCC gates are open for the “number of the days open”
 3 simulated in CalSim II, from the start of the month.

4 The operation of the south Delta temporary barriers is determined dynamically in
 5 using the operating rules feature in DSM2. These operations generally depend on
 6 the season, San Joaquin River flow at Vernalis, and tidal condition in the south
 7 Delta. Similarly, the Montezuma Slough salinity control gate operations are
 8 determined using an operating rule that sets the operations based on the season,
 9 Martinez salinity, and tidal condition in the Montezuma Slough.

10 For salinity, EC at Martinez is estimated using the G-model on a 15-minute time
 11 step, based on the Delta outflow simulated in CalSim II and the pure astronomical
 12 tide at Martinez (Ateljevich 2001a). The monthly averaged EC for the
 13 San Joaquin River at Vernalis estimated in CalSim II for the 82-year period is
 14 used in DSM2. For other river flows, which have low salinity, constant values are
 15 assumed. Monthly average values of the EC associated with Delta agricultural
 16 drainage and return flows were estimated for three regions in the Delta based on
 17 observed data identifying the seasonal trend. These values are repeated for each
 18 year of the simulation.

19 **5A.A.4.3.1 ANN Retraining**

20 ANNs are used for flow-salinity relationships in CalSim II. They are trained on
 21 DSM2 outputs and therefore emulate DSM2 functionality. ANN requires
 22 retraining whenever the flow-salinity relationship in the Delta changes. EIS
 23 analysis assumes 15-cm sea-level rise at Year 2030 that results in a different flow-
 24 salinity relationship in the Delta and therefore required an ANN retrained for the
 25 15-cm sea-level rise by DWR Bay-Delta Modeling Support Branch staff.

26 The ANN retraining process involves the following steps:

- 27 • The DSM2 model is corroborated for each scenario (changed sea level or
 28 Delta physical configuration).
- 29 • A range of example long-term CalSim II scenarios is used to provide a range
 30 of boundary conditions for DSM2 models.
- 31 • Using the grid configuration and the correlations from the corroboration
 32 process, several 16-year planning runs are simulated based on the boundary
 33 conditions from the identified CalSim II scenarios to create a training data set
 34 for each new ANN.
- 35 • ANNs are trained using the Delta flows and DCC operations from CalSim II,
 36 EC results from DSM2, and the Martinez tide.
- 37 • The training data set is divided into two parts; one is used for training the
 38 ANN, and the other to validate.
- 39 • Once the ANN is ready, a full-circle analysis is performed to assess the
 40 performance of the ANN.

1 Detailed description of the ANN training procedure and the full-circle analysis is
 2 provided in DWR’s 2007 annual report (Seneviratne and Wu 2007).

3 **5A.A.4.4 Output Parameters**

4 DSM2 HYDRO provides the following outputs on a 15-minute time step:

- 5 • Tidal flow
- 6 • Tidal stage
- 7 • Tidal velocity

8 The following variables can be derived from the above outputs:

- 9 • Net flows
- 10 • Mean sea level, mean higher high water, mean lower low water, and tidal
 11 range
- 12 • Water depth
- 13 • Tidal reversals
- 14 • Flow splits, etc.

15 DSM2 QUAL provides the following outputs on a 15-minute time step:

- 16 • Salinity (EC)
- 17 • DOC
- 18 • Source water and constituent fingerprinting

19 The following variables can be derived from the above QUAL outputs:

- 20 • Bromide, chloride, and total dissolved solids
- 21 • Selenium and mercury

22 In a planning analysis, the flow boundary conditions that drive DSM2 are
 23 obtained from the monthly CalSim II model. The agricultural diversions, return
 24 flows, and corresponding salinities used in DSM2 are on a monthly time step.
 25 The implementation of DCC gate operations in DSM2 assumes that the gates are
 26 open from the beginning of a month, irrespective of the water quality needs in the
 27 south Delta.

28 The input assumptions stated earlier should be considered when DSM2 EC results
 29 are used to evaluate performance of a baseline or an alternative against the
 30 standards. Even though CalSim II releases sufficient flow to meet the standards
 31 on a monthly average basis, the resulting EC from DSM2 may be over the
 32 standard for part of a month and under the standard for part of the month,
 33 depending on the spring/neap tide and other factors (for example, simplification
 34 of operations). It is recommended that the results are presented on a monthly
 35 basis. Frequency of compliance with a criterion should be computed based on
 36 monthly average results. Averaging on a sub-monthly (14-day or more) scale
 37 may be appropriate as long as the limitations with respect to the compliance of the
 38 baseline model are described in detail and the alternative results are presented as
 39 an incremental change from a baseline model.

1 In general, it is appropriate to present DSM2 QUAL results including EC, DOC,
2 volumetric fingerprinting, and constituent fingerprinting on a monthly time step.
3 When comparing results between two scenarios, computing differences based on
4 these mean monthly statistics is appropriate.

5 **5A.A.4.5 Modeling Limitations**

6 DSM2 is a one-dimensional model with inherent limitations in simulating
7 hydrodynamic and transport processes in a complex estuarine environment such
8 as the Delta. DSM2 assumes that velocity in a channel can be adequately
9 represented by a single average velocity over the channel cross-section, meaning
10 that variations both across the width of the channel and through the water column
11 are negligible. DSM2 does not have the ability to model short-circuiting of flow
12 through a reach, where a majority of the flow in a cross-section is confined to a
13 small portion of the cross-section. DSM2 does not conserve momentum at the
14 channel junctions and does not model the secondary currents in a channel. DSM2
15 also does not explicitly account for dispersion due to flow accelerating through
16 channel bends. It cannot model the vertical salinity stratification in the channels.

17 It has inherent limitations in simulating the hydrodynamics related to the open
18 water areas. Since a reservoir surface area is constant in DSM2, it impacts the
19 stage in the reservoir and thereby impacts the flow exchange with the adjoining
20 channel. Due to the inability to change the cross-sectional area of the reservoir
21 inlets with changing water surface elevation, the final entrance and exit
22 coefficients were fine-tuned to match a median flow range. This causes errors in
23 the flow exchange at breaches during the extreme spring and neap tides. Using an
24 arbitrary bottom elevation value for the reservoirs representing the proposed
25 marsh areas to get around the wetting-drying limitation of DSM2 may increase
26 the dilution of salinity in the reservoirs. Accurate representation of tidal marsh
27 areas, bottom elevations, location of breaches, breach widths, cross-sections, and
28 boundary conditions in DSM2 is critical to the agreement of corroboration results.

29 For open waterbodies DSM2 assumes uniform and instantaneous mixing over the
30 entire open water area. Thus, it does not account for any salinity gradients that
31 may exist within the open waterbodies. Significant uncertainty exists in flow and
32 EC input data related to in-Delta agriculture, which leads to uncertainty in the
33 simulated EC values. Caution needs to be exercised when using EC outputs on a
34 sub-monthly scale. Water quality results inside the waterbodies representing the
35 tidal marsh areas were not validated specifically, and because of the bottom
36 elevation assumptions, preferably should not be used for analysis.

37 **5A.A.4.6 Linkages to Other Models**

38 The Delta boundary flows and exports from CalSim II are used to drive the DSM2
39 Delta hydrodynamic and water quality models for estimating tidally based flows,
40 stage, velocity, and salt transport within the estuary. DSM2 water quality and
41 volumetric fingerprinting results are used to assess changes in concentration of
42 selenium and methylmercury in Delta waters.

1 DSM2 results are also used for fisheries models (IOS, DPM) or aquatics species
 2 survival/habitat relationships developed based on peer-reviewed scientific
 3 publications.

4 **5A.A.5 Climate Change and Sea-Level Rise**

5 The EIS uses a representation of potential climate change and sea-level rise
 6 change in numerical models that simulate hydrologic and hydrodynamic
 7 conditions in the study area in addition to changes in river flows due to changes in
 8 operations and diversions. This approach is based upon the methods used in
 9 development of BDCP EIR/EIS (DWR et al 2013).

10 This section provides brief information on methods used for this EIS.

11 **5A.A.5.1 Climate Change**

12 A growing body of evidence indicates that Earth’s atmosphere is warming.
 13 Records show that surface temperatures have risen about 0.7°C since the early
 14 twentieth century and that 0.5°C of this increase has occurred since 1978
 15 (NAS 2006). Observed changes in oceans, snow and ice cover, and ecosystems
 16 are consistent with this warming trend (NAS 2006, IPCC 2007). The temperature
 17 of Earth’s atmosphere is directly related to the concentration of atmospheric
 18 greenhouse gases. Growing scientific consensus suggests that climate change will
 19 be inevitable as the result of increased concentrations of greenhouse gases and
 20 related temperature increases (IPCC 2007, Kiparsky and Gleick 2003, Cayan et al.
 21 2009, USGRP 2013).

22 Observed climate and hydrologic records indicate that more substantial warming
 23 has occurred since the 1970s and that this is likely a response to the increases in
 24 greenhouse gas (GHG) increases during this time. The recent suite of global
 25 climate models (GCMs), a part of the Coupled Model Intercomparison Project
 26 Phase 3 (CMIP3)¹ and Intergovernmental Panel on Climate Change (IPCC)
 27 Fourth Assessment Report (AR4), when simulated under future GHG emission
 28 scenarios and current atmospheric GHGs, exhibit warming globally and
 29 regionally over California. In the early part of the twenty-first century, the
 30 amount of warming produced by the higher-emission A2 scenario is not very
 31 different from the lower-emission B1 scenario, but becomes increasingly larger
 32 through the middle and especially the latter part of the century. Six GCMs
 33 selected for the 2009 scenarios project by the California Climate Action Team
 34 project a mid-century temperature increase of about 1°C to 3°C (1.8°F to 5.4°F),
 35 and an end-of-century increase from about 2°C to 5°C (3.6°F to 9°F) (Cayan et al.
 36 2009). Precipitation in most of California is dominated by extreme variability,
 37 seasonally, annually, and over decade time scales. The GCM simulations of

¹ At the time of methods selection for the EIS, Coupled Model Intercomparison Project Phase 3 (CMIP3) projections were the most recently available ensembles. Even though Coupled Model Intercomparison Project Phase 5 (CMIP5) was released by the IPCC (after the methods selection for the EIS) in 2013, the use of CMIP3 ensembles are deemed appropriate because the differences in the projected changes in annual precipitation and temperature between the CMIP3 and CMIP5 projections are relatively small over the Central Valley by the end of 2030.

1 historical climate capture the historical range of variability reasonably well
2 (Cayan et al. 2009), but historical trends are not well captured in these models.
3 Projections of future precipitation are much more uncertain than those for
4 temperature. As climate changes, California is expected to be subjected to
5 alterations in natural hydrologic conditions, including changes in snow
6 accumulation and stream flow availability.

7 **5A.A.5.2 Sea-Level Rise**

8 Global and regional sea levels have been increasing steadily over the past century
9 and are expected to continue to increase throughout this century. Over the past
10 several decades, sea level measured at tide gages along the California coast has
11 risen at a rate of about 17 to 20 cm (6.7 to 7.9 inches) per century (Cayan et al.
12 2009). While there is considerable variability among the gages along the Pacific
13 Coast, primarily reflecting local differences in vertical movement of the land and
14 length of gage record, this observed rate in mean sea level is similar to the global
15 mean trend (NOAA 2012). Global estimates of sea-level rise made in the most
16 recent assessment by the IPCC (2007) indicate a range of 18 to 59 cm (7.1 to
17 23.2 inches) this century. However, since the release of the IPCC AR4, advances
18 have occurred in the understanding of sea-level rise. These advances in the
19 science have led to criticism of the approach used by the IPCC. Recent work by
20 Rahmstorf (2007), Vermeer and Rahmstorf (2009), and others suggests that the
21 sea-level rise may be substantially greater than the IPCC projections.

22 Empirical models based on the observed relationship between global temperatures
23 and sea levels have been shown to perform better than the IPCC models in
24 reconstructing recent observed trends. Rahmstorf (2007) and Vermeer and
25 Rahmstorf (2009) demonstrated that such a relationship, when applied to the
26 range of emission scenarios of IPCC (2007), results in a mid-range rise this
27 century of 70 to 100 cm (28 to 39 inches), with a full range of variability of 50 to
28 140 cm (20 to 55 inches). The CALFED Science Program (CALFED 2007),
29 State of California, and others have made assessments of the range of potential
30 future sea-level rise throughout 21st century.

31 In 2011, the United States Army Corps of Engineers (USACE) issued guidance
32 on incorporating sea-level change in civil works programs (USACE 2011). The
33 guidance document reviews the existing literature and suggests use of a range of
34 sea-level change projections, including the “high probability” of accelerating
35 global sea-level rise. The ranges of future sea-level rise were based on the
36 empirical procedure recommended by the National Research Council and updated
37 for recent conditions (NRC 1987). The three scenarios included in the USACE
38 guidance suggest end-of-century sea-level rise in the range of 50 to 150 cm (20 to
39 59 inches), consistent with the range of projections by Rahmstorf (2007) and
40 Vermeer and Rahmstorf (2009). The USACE Bulletin expired in
41 September 2013.²

² At the time of methods selection for the EIS, USACE 2011 was the most recent guidance. Current most recent guidance (USACE 2013) suggests evaluation of a low, medium, and high sea-level rise. The projected mean sea level rise ranges between 10 cm and 14 cm at 2030 relative to year 2000 based on the recent NRC

1 The recent NRC study (NRC 2012) on west coast sea-level rise relies on estimates
 2 of the individual components that contribute to sea-level rise and then sums those
 3 to produce the projections. The recent NRC sea-level rise projections for
 4 California have wider ranges, but the upper limits are not as high as those from
 5 Vermeer and Rahmstorf's (2009) global projections. The California State
 6 Sea-Level Rise Guidance Document (CO-CAT 2013) was updated in March 2013
 7 with the scientific findings of the 2012 NRC report.

8 As sea-level rise progresses during the century, the hydrodynamics of the San
 9 Francisco Bay-Sacramento-San Joaquin Delta estuary will change, causing the
 10 salinity of water in the Delta estuary to increase. This increasing salinity will
 11 most likely have significant impacts on water management throughout the Central
 12 Valley and other regions of the state.

13 **5A.A.5.3 Incorporating Climate Change and Sea-Level Rise in EIS** 14 **Simulations**

15 Incorporation of climate change in water resources planning continues to be an
 16 area of evolving science, methods, and applications. Several potential approaches
 17 exist for incorporating climate change in the resources impact analyses.

18 Currently, there is no standardized methodology that has been adopted by either
 19 the State of California or the Federal agencies for use in impact assessments. The
 20 courts have ruled that climate change must be considered in the planning of
 21 long-term water management projects in California, but have not been
 22 prescriptive in terms of methodologies to be applied. Climate change could be
 23 addressed in a qualitative and/or quantitative manner, could focus on global
 24 climate model projections or recent observed trends, and could explore broader
 25 descriptions of observed variability by blending paleoclimate information into this
 26 understanding.

27 **5A.A.5.3.1 Incorporating Climate Change**

28 The climate change scenarios were developed from an ensemble of 112 bias-
 29 corrected, spatially downscaled GCM simulations from 16 climate models for
 30 SRES emission scenarios A2, A1B, and B1 from the CMIP3 that are part of the
 31 IPCC AR4. The future projected changes over the 30-year climatological period
 32 centered on 2025 (i.e., 2011-2040 to represent 2025 timeline) were combined
 33 with a set of historically observed temperatures and precipitation to generate
 34 climate sequences that maintain important multi-year variability not always
 35 reproduced in direct climate projections.

36 In an effort to summarize these 112 scenarios, five statistically representative
 37 climate change scenarios were developed to characterize the central tendency, and
 38 the range of the ensemble uncertainty.

(2012) study and using the USACE Sea Level Change Curve Calculator (2015.46) located at <http://www.corpsclimate.us/ccaceslcurves.cfm>. The mean projected sea-level rise is similar to the EIS assumption of 15 cm at Year 2030. Due to the considerable uncertainty in the future sea-level change projections and the state of sea-level rise science, the use of 15 cm sea-level rise for the EIS was deemed reasonable.

1 Since the ensemble is made up of many projections, it is useful to identify the
2 median (50th percentile) change of both annual temperature and annual
3 precipitation. In doing so, the state of climate change at this point in time can be
4 broken into quadrants representing (1) drier, less warming, (2) drier, more
5 warming, (3) wetter, more warming, and (4) wetter, less warming than the
6 ensemble median (Q1 through Q4). In addition, a fifth region (Q5) can be
7 described that samples from inner-quartiles (25th to 75th percentile) of the
8 ensemble and represents a central region of climate change. In each of the five
9 regions the sub-ensemble of climate change projections, made up of those
10 contained within the region bounds, is identified. The Q5 scenario is derived
11 from the central tending climate projections and thus favors the consensus of the
12 ensemble.

13 Through extensive coordination with the State and Federal teams involved in the
14 BDCP, the bounding scenarios Q1-Q4 were refined in April 2010 to reduce the
15 attenuation of climate projection variability that comes about through the use of
16 larger ensembles. A sensitivity analysis was prepared for the bounding scenarios
17 (Q1-Q4) using sub-ensembles made up of different numbers of downscaled
18 climate projections. The sensitivity analysis was prepared using a “nearest
19 neighbor” (k-NN) approach. In this approach, a certain joint projection
20 probability is selected based on the annual temperature change-precipitation
21 change (i.e. 90th percentile of temperature and 90th percentile of precipitation
22 change). From this statistical point, the “k” nearest neighbors (after normalizing
23 temperature and precipitation changes) of projections are selected and climate
24 change statistics are derived. Consistent with the approach applied in 2008 LTO
25 BA, the 90th and 10th percentile of annual temperature and precipitation change
26 were selected as the bounding points. The sensitivity analysis considered using
27 the 1-NN (single projection), 5-NN (5 projections), and 10-NN (10 projections)
28 sub-ensemble of projections. These were compared to the original quadrant
29 scenarios which commonly are made up of 25-35 projections and are based on the
30 direction of change from 50th percentile statistic. The very small ensemble
31 sample sizes exhibited month by month changes that were sometimes
32 dramatically different than that produced by adding a few more projections to the
33 ensemble. The 1-NN approach was found to be inferior to all other methods for
34 this reason. The original quadrant method produced a consensus direction of
35 change of the projections, and thus produced seasonal trends that were more
36 realistic, but exhibited a slightly smaller range due to the inclusion of several
37 central tending projections. The 5-NN and 10-NN methods exhibited slightly
38 wider range of variability than the quadrant method which was desirable from the
39 “bounding” approach. In most cases the 5-NN and 10-NN projections were
40 similar, although they differed at some locations in representation of season trend.
41 The 10-NN approach was found to be preferable in that it best represented the
42 seasonal trends of larger ensembles, retained much of the “range” of the smaller
43 ensembles, and was guaranteed to include projections from at least two GCM-
44 emission scenario combinations (in the CMIP3 projection archive, up to 5
45 projections – multiple simulations – could come from one GCM-emission
46 scenario combination). The State and Federal representatives agreed to utilize the

1 following climate scenario selection process for BDCP: (1) the use of the original
2 quadrant approach for Q5 (projections within the 25th to 75th percentile bounding
3 box) as it provides the best estimate of the consensus of climate projections and
4 (2) the use of the 10-NN method to developing the Q1-Q4 bounding scenarios.
5 An automated process was developed that generates the monthly and annual
6 statistics for every grid cell within the Central Valley domain and identifies the
7 members of the sub ensemble for consideration in each of the five scenarios.

8 For the purposes of this EIS, Q5 climate change scenario for the period centered
9 on 2025 is used for all alternatives analyses and represents conditions at 2030.
10 The Q5 scenario was derived from the central tending “consensus” of the climate
11 projections and thus represents the median ensemble projection. Figures 5A.A.5
12 through 5A.A.8 present projected changes in temperature and precipitation for the
13 2025 timeline for select locations that represent Sacramento, San Joaquin, and
14 Delta systems.

15 The modified temperature and precipitation inputs were used in the VIC
16 hydrology model to simulate hydrologic processes on the 1/8th degree scale to
17 produce watershed runoff (and other hydrologic variables) for the major rivers
18 and streams in the Central Valley.

19 To compute watershed runoff, the VIC model was simulated in water balance
20 mode. In this mode, a complete land surface water balance is computed for each
21 grid cell on a daily basis for the entire model domain. Unique to the VIC model is
22 its characterization of sub-grid variability. Sub-grid elevation bands enable more
23 detailed characterization of snow-related processes. Five elevation bands are
24 included for each grid cell. In addition, VIC also includes a sub-daily (1 hour)
25 computation to resolve transients in the snow model. The soil column is
26 represented by three soil zones extending from land surface in order to capture the
27 vertical distribution of soil moisture. The VIC model represents multiple
28 vegetation types as uses NASA’s Land Data Assimilation System (LDAS)
29 databases as the primary input data set.

30 The VIC model computes the water balance over each grid cell on a daily basis
31 for the entire period of simulation. For the simulations performed for the BDCP,
32 water balance variables such as precipitation, evapotranspiration, runoff,
33 baseflow, soil moisture, and snow water equivalent were included as output. In
34 order to facilitate understanding of these watershed process results, nine locations
35 throughout the in the watershed were selected for more detailed review. These
36 locations are representative points within each of the following hydrologic basins:
37 Upper Sacramento River, Feather River, Yuba River, American River, Stanislaus
38 River, Tuolumne River, Merced River, and Upper San Joaquin River. The flow
39 in these main rivers were included in the Eight River Index which is the broadest
40 measure of total flow contributing to the Delta. A ninth location was selected to
41 represent conditions within the Delta.

42 Streamflow was routed to 21 locations that generally align with long-term
43 gauging stations throughout the watershed. The flow at these locations also
44 allowed for assessment of changes in various hydrologic indices used in water

1 management in the Sacramento-San Joaquin Delta. Flows were output in both
2 daily and monthly time steps. Only the monthly flows were used in subsequent
3 analyses. It is important to note that VIC routed flows were considered
4 “naturalized” in that they do not include effects of diversions, imports, storage, or
5 other human management of the water resource. Figures 5A.A.9 through
6 5A.A.18 present projected changes in watershed runoff for the major rivers and
7 streams in the Central Valley for the 2025 timeline.

8 These simulated changes in runoff were applied to the CalSim II inflows as a
9 fractional change from the observed inflow patterns (simulated future runoff
10 divided by historical runoff). These fraction changes were first applied for every
11 month of the 82-year period consistent with the VIC simulated patterns. A second
12 correction was then applied to ensure that the annual shifts in runoff at each
13 location are consistent with that generated from the VIC modeling.


14 Once the changes in flows had been resolved, water year types and other
15 hydrologic indices that govern water operations or compliance were adjusted to
16 be consistent with the new hydrologic regime. The changes in reservoir inflows,
17 key valley floor accretions, and water year types and hydrologic indices were
18 translated into modified input time series for the CalSim II model.

19 For the BDCP EIR/EIS, the CalSim II model was simulated with each of the five
20 climate change hydrologic conditions (including effects of sea level rise) in
21 addition to the historical hydrologic conditions for the No Project/No Action
22 Alternative and one other alternative to understand the sensitivity of projected
23 operations to the range of climate change scenarios. The results of that analysis
24 indicated that the incremental differences between the No Action Alternative and
25 the other alternative were consistent at Q1 through Q5 conditions, although
26 absolute values were different (DWR et al, 2013).

27 **5A.A.5.3.2 Incorporation of Sea-Level Rise**


28 For sea-level rise simulation, using the work conducted by Rahmstorf, it was
29 assumed the projected sea-level rise at the early long-term timeline (2025) would
30 be approximately 12 to 18 cm (5 to 7 inches). At the late long-term timeline
31 (2060), the projected sea-level rise was assumed to be approximately 30 to 60 cm
32 (12 to 24 inches).

33 These sea-level rise estimates were consistent with those outlined in the recent
34 USACE guidance circular for incorporating sea-level changes in civil works
35 programs (USACE 2013). Due to the considerable uncertainty in these
36 projections and the state of sea-level rise science, it was proposed to use the mid-
37 range of the estimates of 15 cm (6 inches) by 2025 and 45 cm (18 inches) by
38 2060. For the purposes of the EIS, the sea-level rise scenario for the period
39 centered on 2025 is used (DWR et al. 2013). This period is considered because
40 the EIS extends only up to 2030. These changes were simulated in Bay-Delta
41 hydrodynamics models, and their effect on the flow-salinity relationship in the
42 Bay-Delta was incorporated into CalSim II modeling through the use of ANNs
43 that were developed for the BDCP EIR/EIS (DWR et al 2013) for the same sea-
44 level rise and physical Delta conditions.

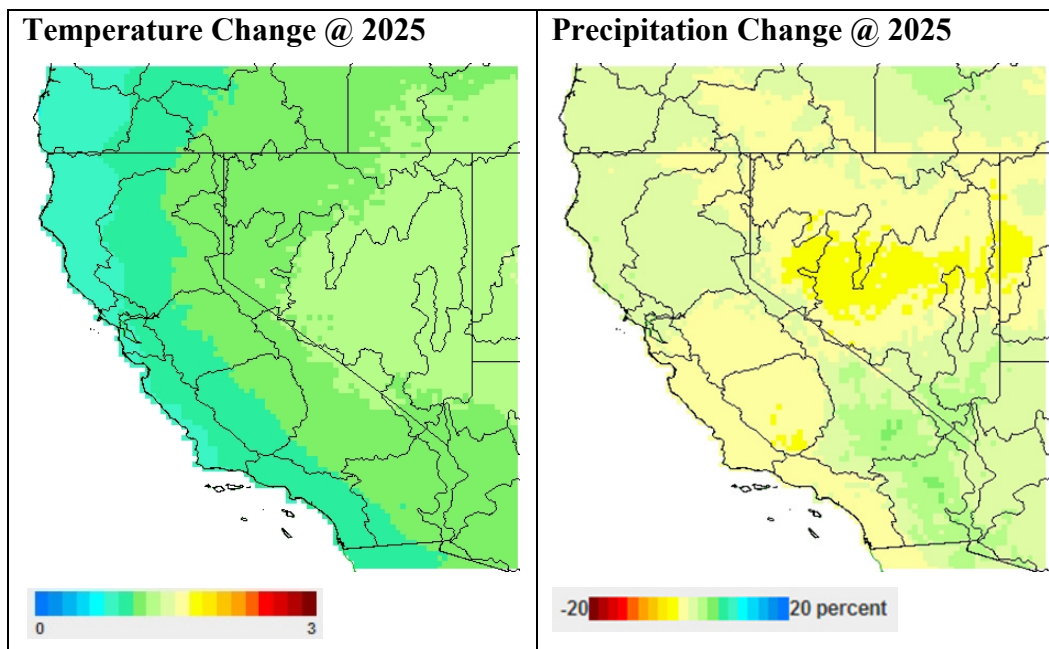


- 1 **Figure 5A.A.5 Projected Changes in Annual Temperature (as degrees C) and**
- 2 **Precipitation (as percent change) for the Period 2011-2040 (2025) as Compared to**
- 3 **the 1971-2000 Historical Period**


- 4 Derived from Daily Gridded Observed Meteorology (Maurer et al. 2002).

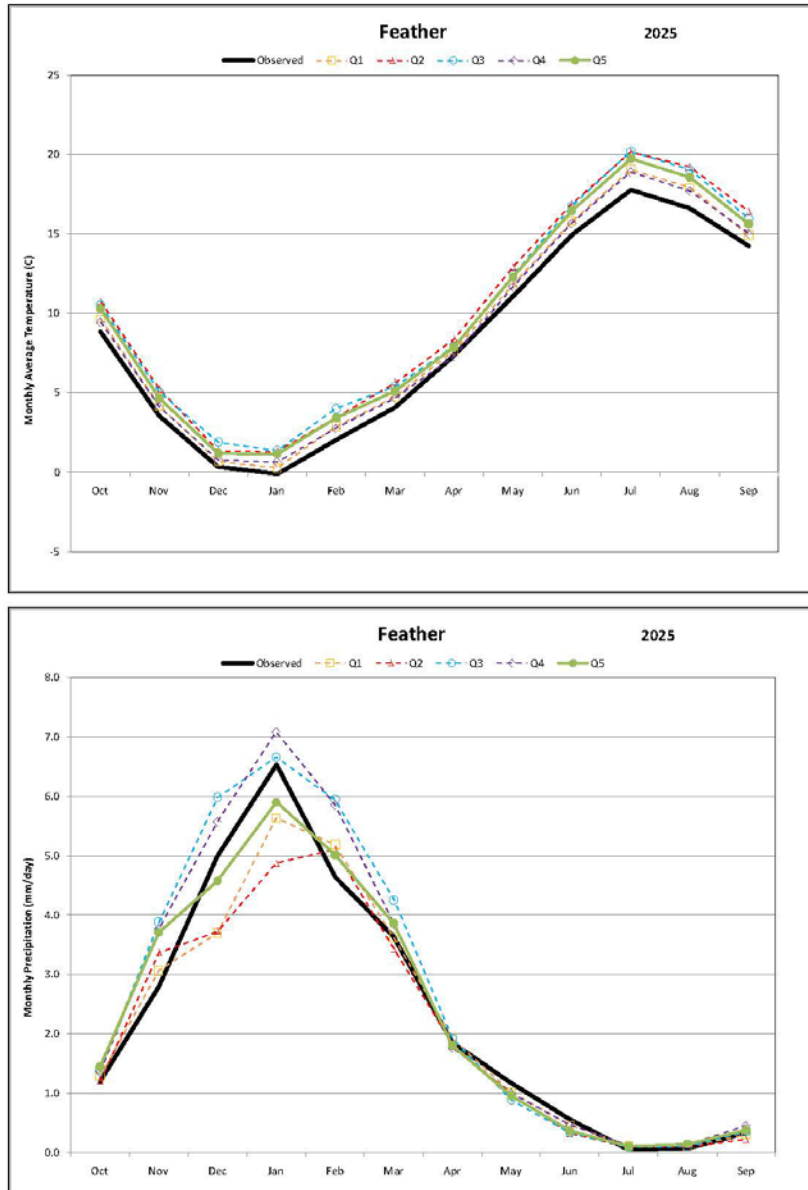


1 **Figure 5A.A.6 Projected Changes in Seasonal Temperature (top) and Precipitation**
 2 **(bottom) for a Grid Cell in the Feather River Basin**

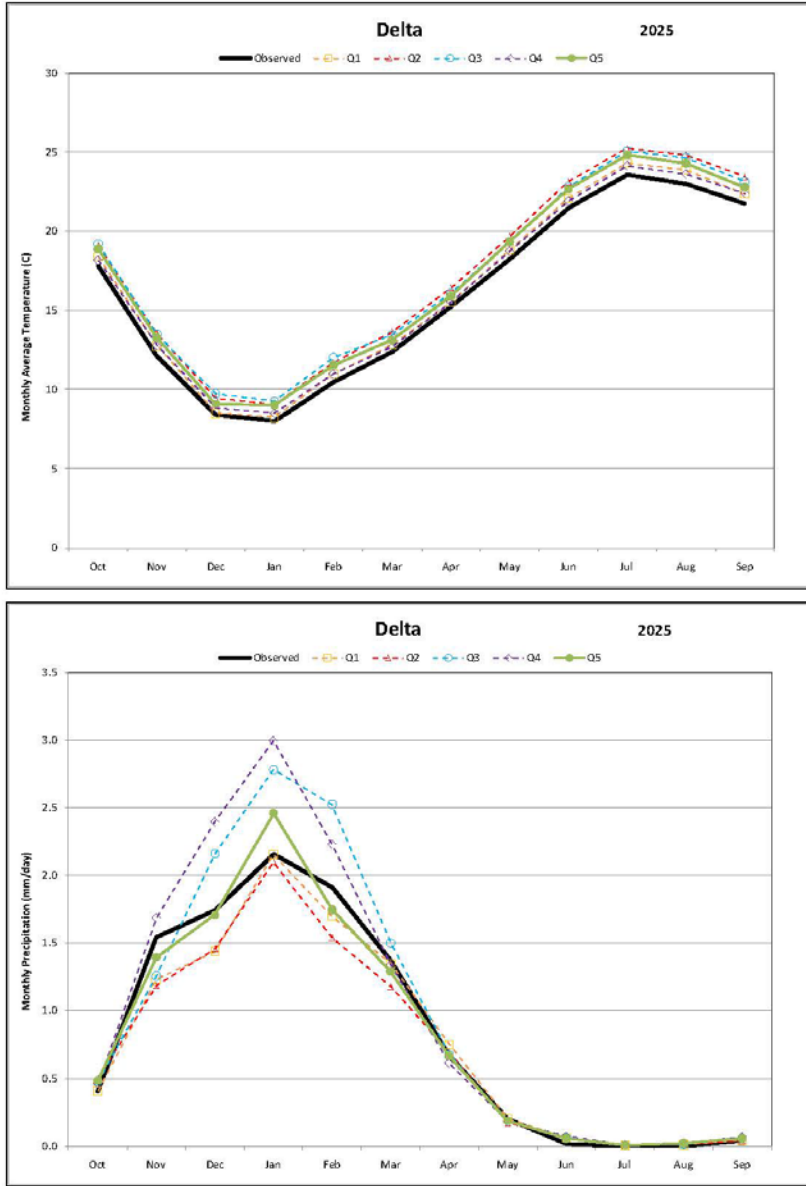

1 Figure 5A.A.7 Projected Changes in Seasonal Temperature (top) and Precipitation
 2 (bottom) for a Grid Cell in the Delta

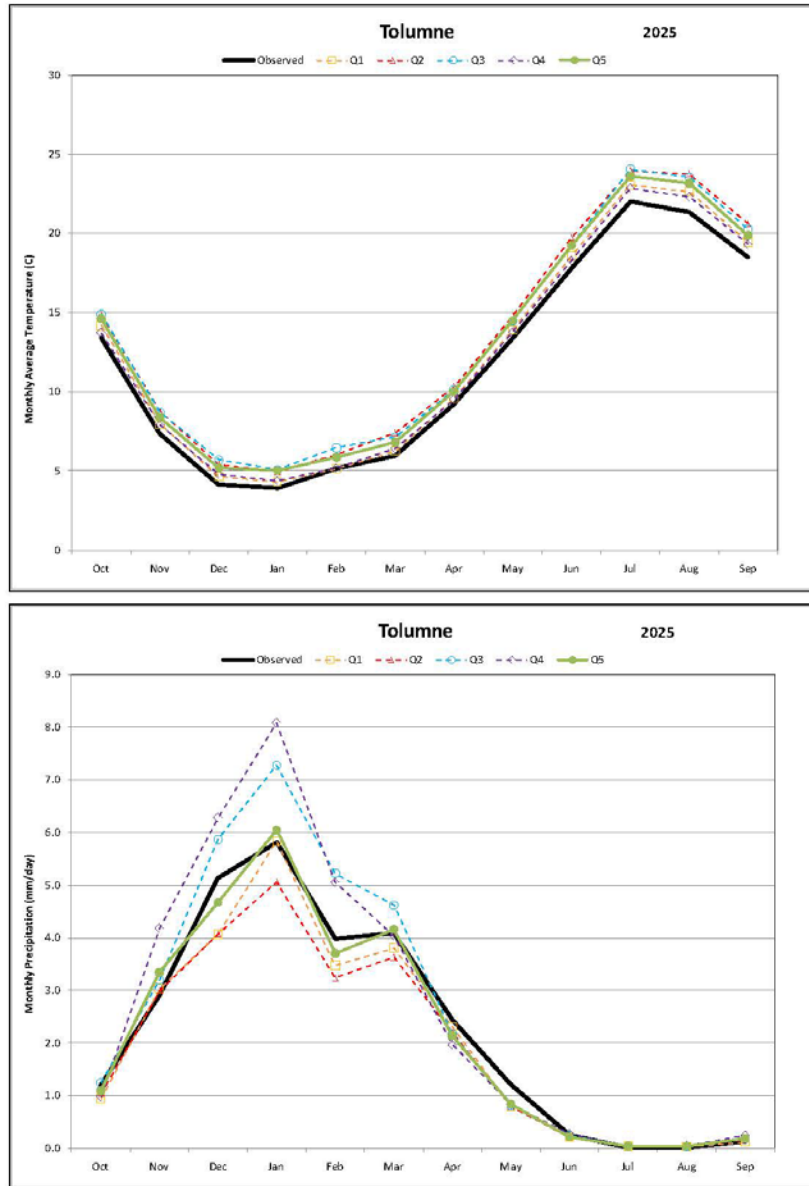


1 **Figure 5A.A.8 Projected Changes in Seasonal Temperature (top) and Precipitation**
 2 **(bottom) for a Grid Cell in the Tuolumne River Basin**

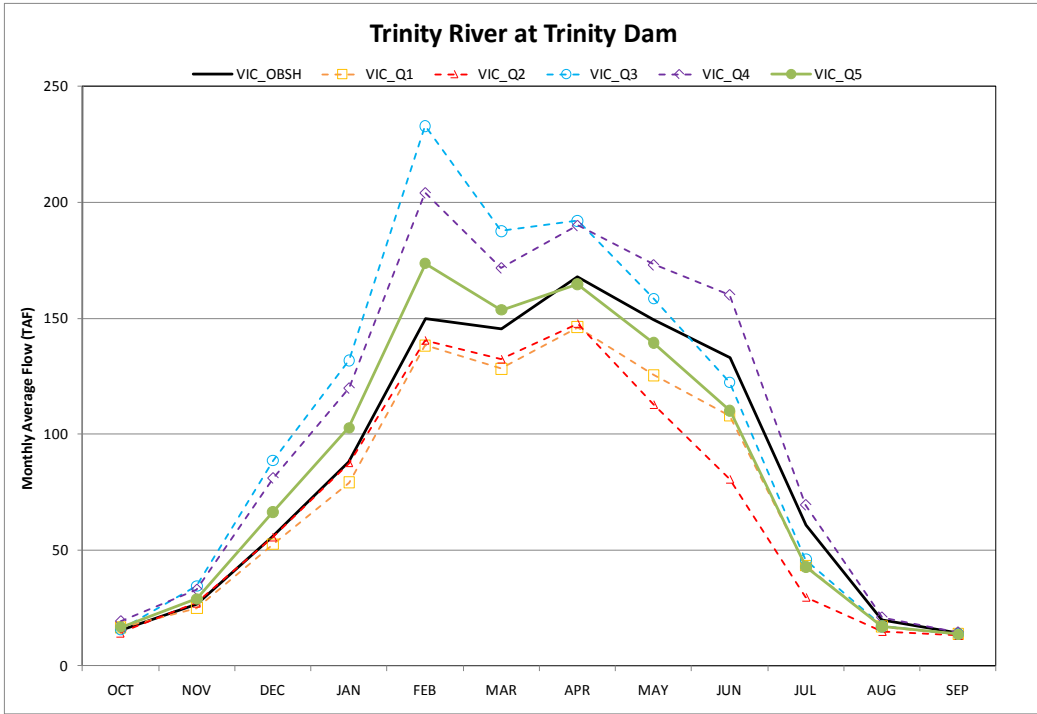


1

2 **Figure 5A.A.9 Simulated Changes in Monthly Natural Streamflow for Trinity River at**
 3 **Trinity Dam (for the 2025 timeline)**

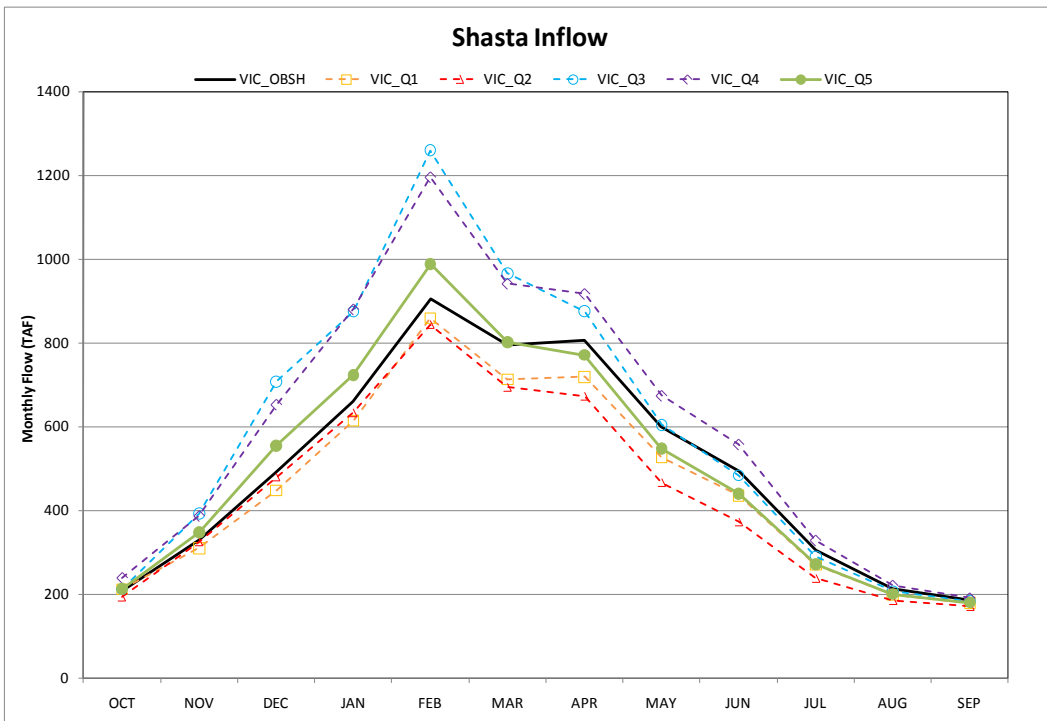


4

5 **Figure 5A.A.10 Simulated Changes in Monthly Natural Streamflow for Shasta Inflow**
 6 **(for the 2025 timeline)**

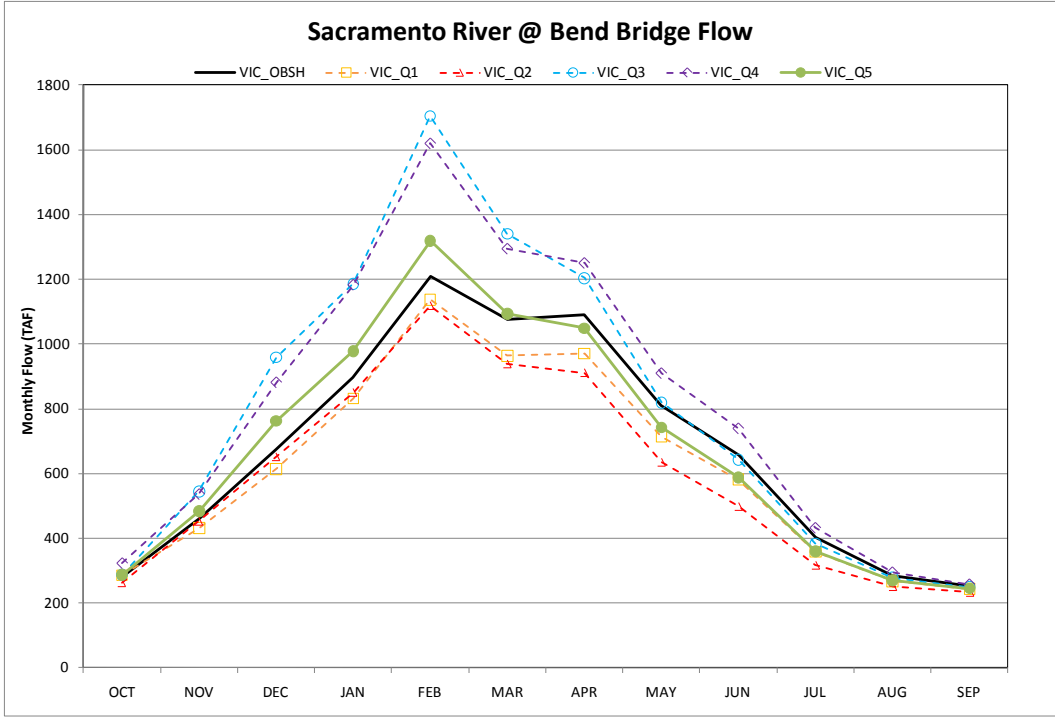


1

2 **Figure 5A.A.11 Simulated Changes in Monthly Natural Streamflow for Sacramento**
 3 **River at Bend Bridge (for the 2025 timeline)**

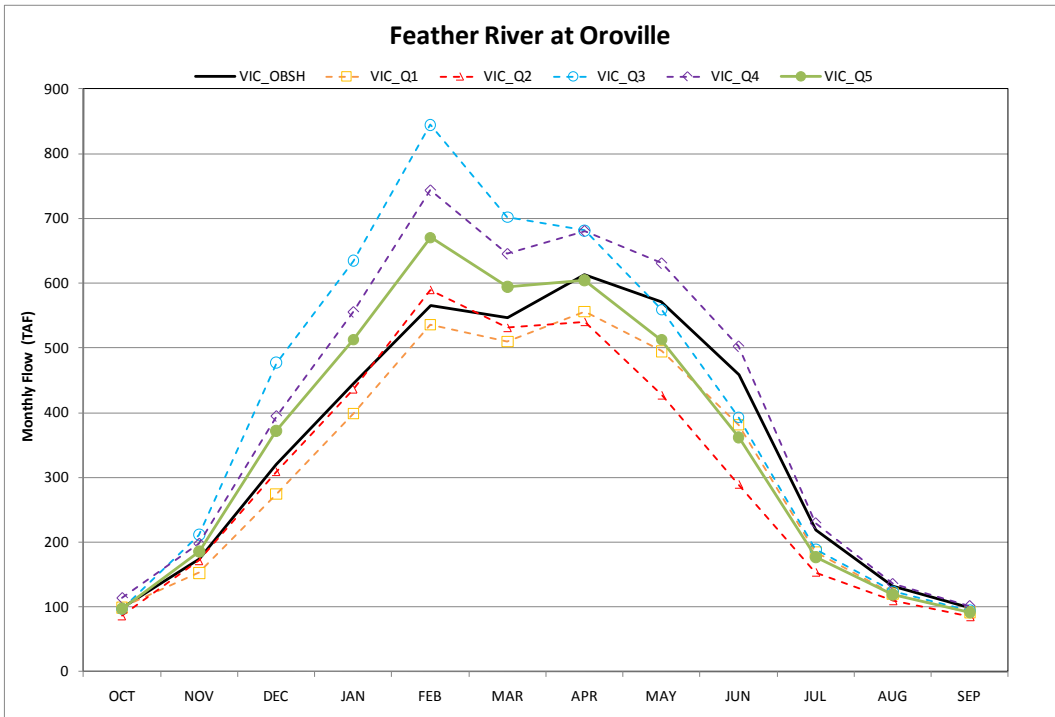

4

5 **Figure 5A.A.12 Simulated Changes in Monthly Natural Streamflow for Feather River**
 6 **at Oroville (for the 2025 timeline)**

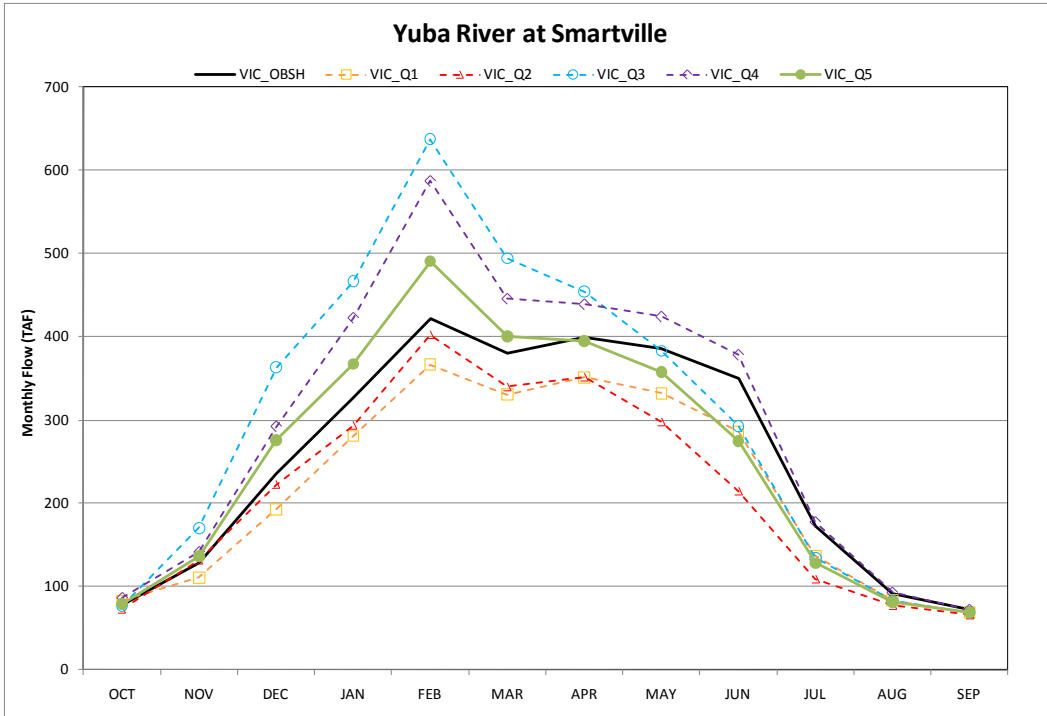


1

2

Figure 5A.A.13 Simulated Changes in Monthly Natural Streamflow for Yuba River at Smartville (for the 2025 timeline)

3

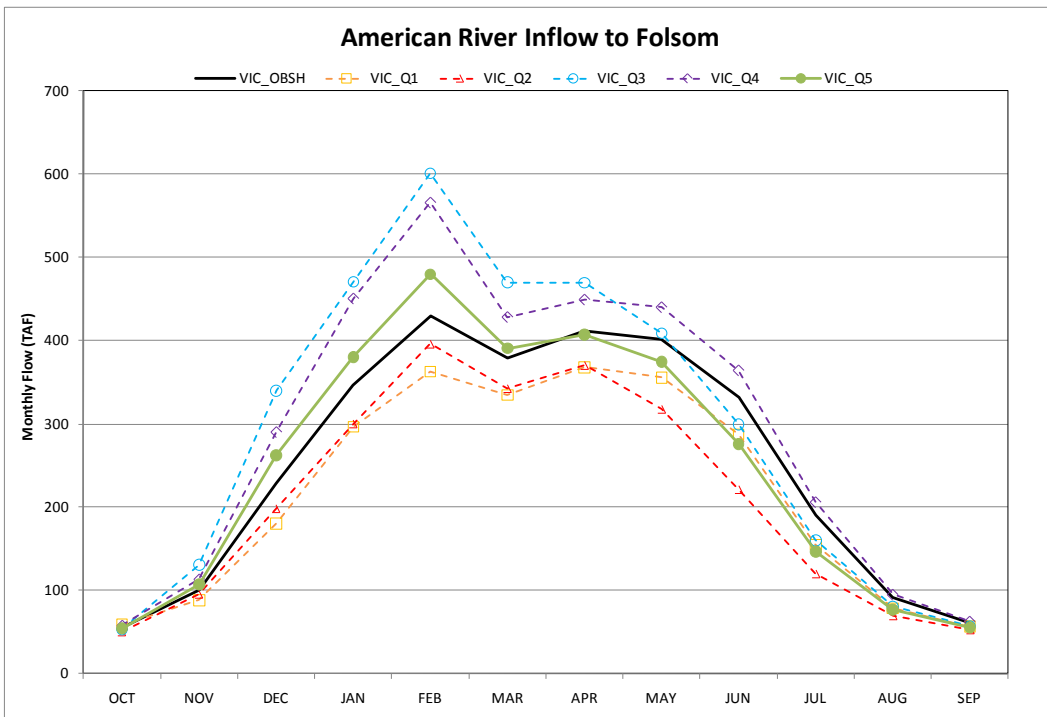


4

5


Figure 5A.A.14 Simulated Changes in Monthly Natural Streamflow for American River Inflow to Folsom (for the 2025 timeline)

6

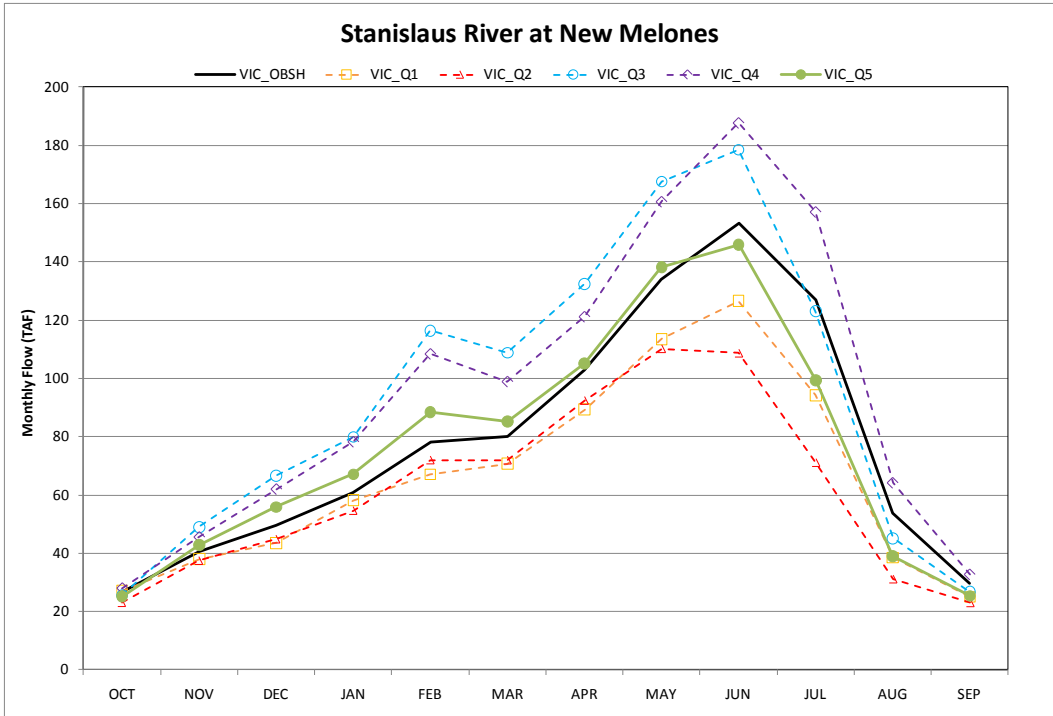


1

2 **Figure 5A.A.15 Simulated Changes in Monthly Natural Streamflow for Stanislaus**
 3 **River at New Melones (for the 2025 timeline)**

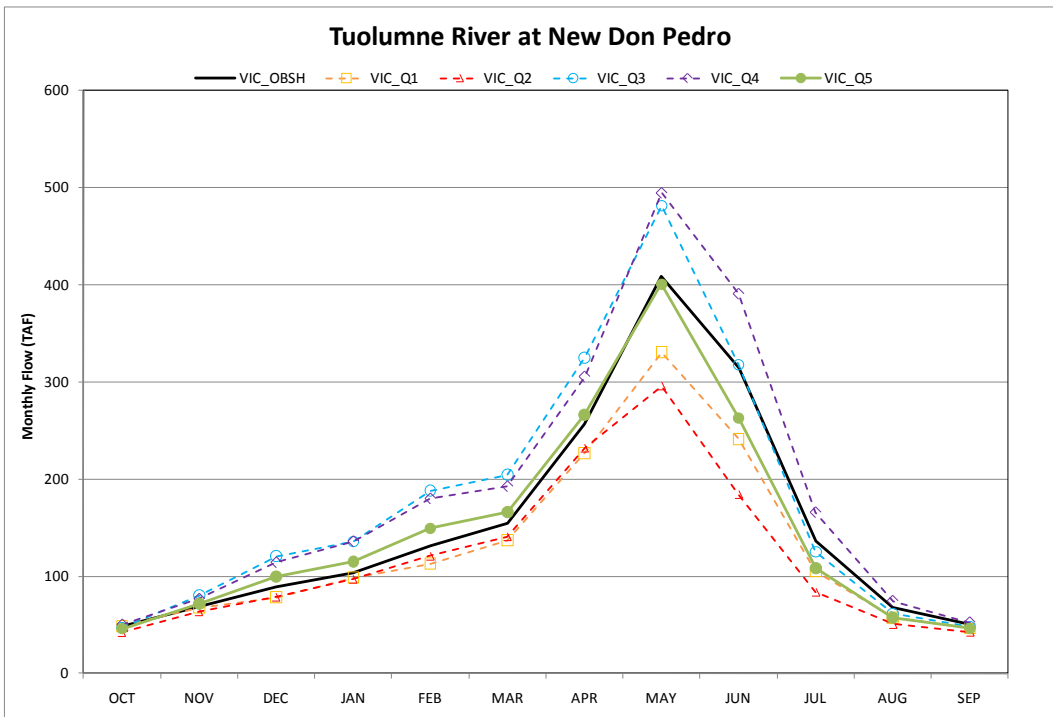

4

5 **Figure 5A.A.16 Simulated Changes in Monthly Natural Streamflow for Tuolumne**
 6 **River at New Don Pedro (for the 2025 timeline)**

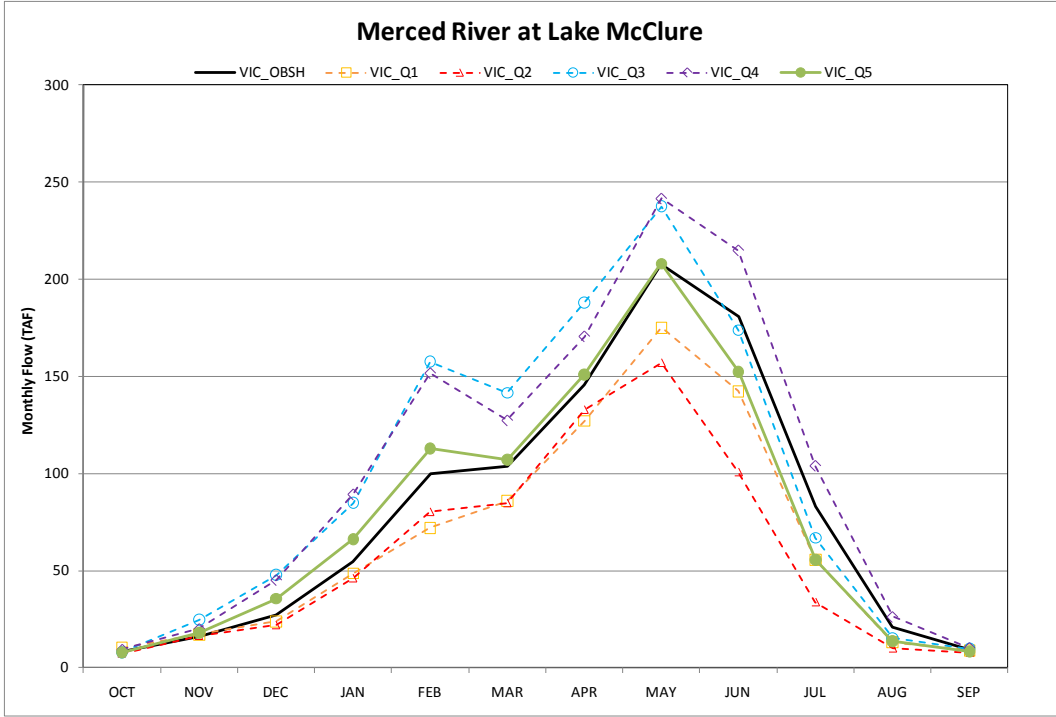


1

2

Figure 5A.A.17 Simulated Changes in Monthly Natural Streamflow for Merced River at Lake McClure (for the 2025 timeline)

3

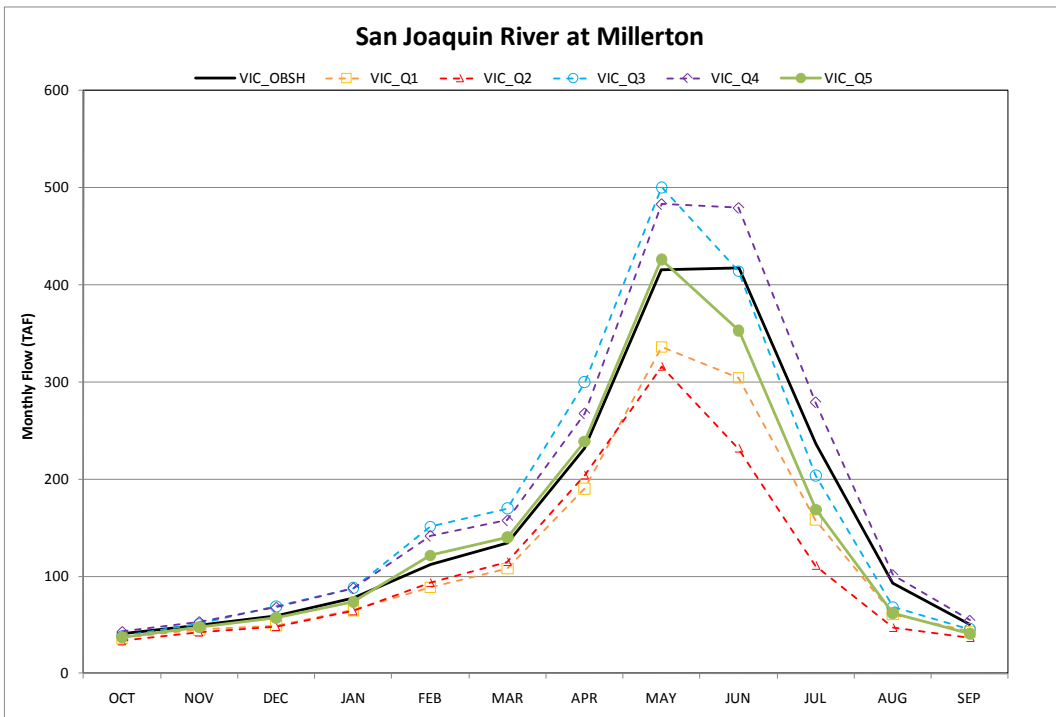

4

5

Figure 5A.A.18 Simulated Changes in Monthly Natural Streamflow for San Joaquin River at Millerton (for the 2025 timeline)

6

1 **5A.A.5.4 Climate Change and Sea-Level Rise Modeling Limitations**

2 GCMs represent different physical processes in the atmosphere, ocean,
3 cryosphere, and land surface. GCMs are the most advanced tools currently
4 available for simulating the response of the global climate system to increasing
5 greenhouse gas concentrations. However, several of the important processes are
6 either missing or inadequately represented in today's state-of-the-art GCMs.
7 GCMs depict the climate using a three dimensional grid over the globe at a coarse
8 horizontal resolution. A downscaling method is generally used to produce finer
9 spatial scale that is more meaningful in the context of local and regional impacts
10 than the coarse-scale GCM simulations.

11 In this study, downscaled climate projections using the Bias-correction and
12 Spatial Disaggregation (BCSD) method is used ([http://gdo-](http://gdo-dcp.ucllnl.org/downscaled_cmip_projections/dcpInterface.html#About)
13 [dcp.ucllnl.org/downscaled_cmip_projections/dcpInterface.html#About](http://gdo-dcp.ucllnl.org/downscaled_cmip_projections/dcpInterface.html#About)). The
14 BCSD downscaling method is well tested and widely used, but it has some
15 inherent limitations such as stationary assumptions used in the BCSD
16 downscaling method (Maurer et al. 2007; Reclamation 2013) and also due to the
17 fact that bias correction procedure employed in the BCSD downscaling method
18 can modify climate model simulated precipitation changes (Maurer and Pierce,
19 2014). The downscaling method also carries some of the limitations applicable to
20 native GCM simulations.

21 A median climate change scenario that was based on more than a hundred climate
22 change projections was used for characterizing the future climate condition for the
23 purposes of the EIS. Although projected changes in future climate contain
24 significant uncertainty through time, several studies have shown that use of the
25 median climate change condition is acceptable (for example, Pierce et al. 2009).
26 The median climate change is considered appropriate for the EIS because of the
27 comparative nature of the NEPA analysis. Therefore, a sensitivity analysis using
28 the different climate change conditions was not conducted for this study.

29 Projected change in stream flow is calculated using the VIC macroscale
30 hydrologic model. The use of the VIC model is primarily intended to generate
31 changes in inflow magnitude and timing for use in subsequent CalSim II
32 modeling. While the model contains several sub-grid mechanisms, the coarse
33 grid scale should be noted when considering results and analysis of local-scale
34 phenomena. The VIC model is currently best applied for the regional-scale
35 hydrologic analyses. There are several limitations to long-term gridded
36 meteorology related to spatial-temporal interpolation due to limited availability of
37 meteorological stations that provide data for interpolation. In addition, the inputs
38 to the model do not include any transient trends in the vegetation or water
39 management that may affect stream flows; they should only be analyzed from a
40 "naturalized" flow change standpoint. Finally, the VIC model includes three soil
41 zones to capture the vertical movement of soil moisture, but does not explicitly
42 include groundwater. The exclusion of deeper groundwater is not likely a
43 limiting factor in the upper watersheds of the Sacramento and San Joaquin river
44 watersheds that contribute approximately 80 to 90 percent of the runoff to the
45 Delta. However, in the valley floor, interrelation of groundwater and surface

1 water management is considerable. Water management models such as CalSim II
2 should be used to characterize the heavily “managed” portions of the system.

3 **5A.A.6 References**

- 4 Anderson, J. 2003. Chapter 14: DSM2 Fingerprinting Methodology. *Methodology*
5 *for Flow and Salinity Estimates in the Sacramento-San Joaquin Delta and*
6 *Suisun Marsh, 24th Annual Progress Report to the State Water Resources*
7 *Control Board.*
- 8 Anderson, J., and M. Mierzwa. 2002. DSM2 tutorial—an introduction to the Delta
9 Simulation Model II (DSM2) for simulation of hydrodynamics and water
10 quality of the Sacramento–San Joaquin Delta. Draft. February. Delta
11 Modeling Section, Office of State Water Project Planning, California
12 Department of Water Resources
- 13 Ateljovich, E. 2001a. Chapter 10: Planning tide at the Martinez boundary.
14 *Methodology for Flow and Salinity Estimates in the Sacramento-San*
15 *Joaquin Delta and Suisun Marsh, 22nd Annual Progress Report to the*
16 *State Water Resources Control Board.*
- 17 _____. 2001b. Chapter 11: Improving salinity estimates at the Martinez boundary.
18 *Methodology for Flow and Salinity Estimates in the Sacramento-San*
19 *Joaquin Delta and Suisun Marsh, 22nd Annual Progress Report to the*
20 *State Water Resources Control Board.*
- 21 _____, and M. Yu. 2007. Chapter 4: Extended 82-year Martinez planning tide.
22 *Methodology for Flow and Salinity Estimates in the Sacramento-San*
23 *Joaquin Delta and Suisun Marsh, 28th Annual Progress Report to the*
24 *State Water Resources Control Board.*
- 25 CALFED (CALFED Independent Science Board). 2007. Projections of Sea Level
26 Rise for the Delta. A memo from Mike Healey, CALFED lead scientist, to
27 John Kirlin, Executive Director of the Delta Blue Ribbon Task Force,
28 September 6, 2007.
- 29 Cayan D, T. M, Dettinger, H. Hidalgo, T. Das, E. Maurer, P. Bromirski, N.
30 Graham, and R. Flick. 2009. *Climate Change Scenarios and Sea Level*
31 *Rise Estimates for the California 2008 Climate Change Scenarios*
32 *Assessment.*
- 33 CO-CAT. 2013. *State of California Sea-Level Rise Guidance Document.*
34 Developed by the Coastal and Ocean Working Group of the California
35 Climate Action Team (CO-CAT), with science support provided by the
36 Ocean Protection Council’s Science Advisory Team and the California
37 Ocean Science Trust. March 2013 update. Available
38 at: [http://www.opc.ca.gov/webmaster/ftp/pdf/docs/2013_SLR_Guidance](http://www.opc.ca.gov/webmaster/ftp/pdf/docs/2013_SLR_Guidance_Update_FINAL1.pdf)
39 [Update_FINAL1.pdf](http://www.opc.ca.gov/webmaster/ftp/pdf/docs/2013_SLR_Guidance_Update_FINAL1.pdf).

- 1 Draper, A.J., A. Munévar, S. K. Arora, E. Reyes, N. L. Parker, F. I. Chung, and L.
2 E. Peterson. 2004. CalSim: Generalized Model for Reservoir System
3 Analysis. *American Society of Civil Engineers, Journal of Water*
4 *Resources Planning and Management* Vol. 130, No. 6.
- 5 DSM2PWT. 2001. *Enhanced Calibration and Validation of DSM2 HYDRO and*
6 *QUAL*. Draft Final Report, Interagency Ecological Program for the
7 Sacramento-San Joaquin Estuary. November.
- 8 DWR (California Department of Water Resources). 1997. Chapter 2: DSM2
9 Model Development. In *Methodology for Flow and Salinity Estimates in*
10 *the Sacramento-San Joaquin Delta and Suisun Marsh, 18th Annual*
11 *Progress Report to the State Water Resources Control Board*.
- 12 DWR (California Department of Water Resources). 2009. DSM2 Recalibration.
13 October 2009.
- 14 DWR (California Department of Water Resources), Bureau of Reclamation, U.S.
15 Fish and Wildlife Service, and National Marine Fisheries Service.
16 2013. *Environmental Impact Report/Environmental Impact Statement for*
17 *the Bay Delta Conservation Plan. Draft*. December.
- 18 IPCC (Intergovernmental Panel on Climate Change). 2007. *Climate Change*
19 *2007: The Physical Science Basis*. Contribution of Working Group I to the
20 Fourth Assessment Report of the Intergovernmental Panel on Climate
21 Change. Edited by S. Solomon, D. Qin, M. Manning, Z. Chen, M.
22 Marquis, K. B. Averyt, M. Tignor, and H. L. Miller. Cambridge
23 University Press, Cambridge, United Kingdom, and New York, NY, USA.
24 996 pp.
- 25 Kiparsky, M., and P. H. Gleick. 2003. *Climate Change and California Water*
26 *Resources: A Survey and Summary of the Literature*.
- 27 Lower Colorado River Authority. 2008. *Climate Change Study, Report on*
28 *Evaluation Methods and Climate Scenarios. Lower Colorado River*
29 *Authority – San Antonio Water System*.
- 30 Maurer, E.P., A.W. Wood, J. D. Adam, D. P. Lettenmaier, and B. Nijssen. 2002.
31 A long-term hydrologically-based data set of land surface fluxes and states
32 for the conterminous United States. *Journal Climate* 15(22):3237-3251.
- 33 Maurer, E. P., L. Brekke, T. Pruitt, and P. B. Duffy. 2007. Fine-resolution climate
34 projections enhance regional climate change impact studies. *Eos Trans.*
35 *AGU* 88(47), 504.
- 36 Maurer, E. P., and D. W Pierce. 2014. Bias correction can modify climate model
37 simulated precipitation changes without adverse effect on the ensemble
38 mean. *Hydrol. Earth Syst. Sci.* 18, 915-925, doi:10.5194/hess-18-915-
39 2014.
- 40 Mahadevan, N. 1995. *Estimation of Delta Island Diversions and Return Flows*.
41 California Department of Water Resources, Division of Planning.
42 February.

- 1 Nader-Tehrani, P. 1998. Chapter 2: DSM2-HYDRO. *Methodology for Flow and*
2 *Salinity Estimates in the Sacramento-San Joaquin Delta and Suisun*
3 *Marsh, 19th Annual Progress Report to the State Water Resources*
4 *Control Board.*
- 5 NAS (National Academy of Sciences). 2006. *Surface Temperature*
6 *Reconstructions for the Last 2,000 Years.* National Academies Press.
- 7 NOAA (National Oceanic and Atmospheric Administration) Center for
8 Operational Oceanographic Products and Services. 2012. NOAA Tides &
9 Currents website. <http://tidesandcurrents.noaa.gov/sltrends/>.
- 10 NRC (National Research Council). 1987. *Responding to Changes in Sea Level:*
11 *Engineering Implications.*
- 12 _____. 2012. *Sea-Level Rise for the Coasts of California, Oregon, and*
13 *Washington: Past, Present, and Future.* Committee on Sea Level Rise in
14 California, Oregon, and Washington. Board on Earth Sciences and
15 Resources; Ocean Studies Board; Division on Earth and Life Studies.
- 16 Pandey, G. 2001. Chapter 3: Simulation of Historical DOC and UVA Conditions
17 in the Delta. *Methodology for Flow and Salinity Estimates in the*
18 *Sacramento-San Joaquin Delta and Suisun Marsh, 22nd Annual Progress*
19 *Report to the State Water Resources Control Board.*
- 20 Pierce, D. W., T. P. Barnett, B. D. Santer, and P. J. Gleckler. 2009. Selecting
21 global climate models for regional climate change studies. *Proceedings of*
22 *the National Academy of Sciences*, doi:10.1073/pnas.0900094106.
- 23 Rajbhandari, H. 1998. Chapter 3: DSM2-QUAL. *Methodology for Flow and*
24 *Salinity Estimates in the Sacramento-San Joaquin Delta and Suisun*
25 *Marsh, 19th Annual Progress Report to the State Water Resources*
26 *Control Board.*
- 27 Rajbhandari, H. 2003. Chapter 3: Extending DSM2-QUAL Calibration of
28 Dissolved Oxygen. *Methodology for Flow and Salinity Estimates in the*
29 *Sacramento-San Joaquin Delta and Suisun Marsh, 24th Annual Progress*
30 *Report to the State Water Resources Control Board.*
- 31 Rahmstorf, S. 2007. A semi-empirical approach to projecting future sea level.
32 *Science* Vol. 315. January.
- 33 Reclamation (Bureau of Reclamation). 2008a. *2008 Central Valley Project and*
34 *State Water Project Operations Criteria and Plan Biological Assessment,*
35 *Appendix D CalSim II Model.* May.
- 36 _____. 2008b. *2008 Central Valley Project and State Water Project Operations*
37 *Criteria and Plan Biological Assessment,* Appendix F DSM2 Model. May.
- 38 _____. 2008c. *2008 Central Valley Project and State Water Project Operations*
39 *Criteria and Plan Biological Assessment,* Appendix W: Sensitivity and
40 *Uncertainty Analysis.*

- 1 _____ . 2010. *Climate Change and Hydrology Scenarios for Oklahoma Yield*
2 *Studies*. Technical Memorandum 86-68210-2010-01. April.
- 3 _____ . 2013. *Downscaled CMIP3 and CMIP5 Climate Projections*. [http://gdo-
dcp.ucllnl.org/downscaled_cmip_projections/techmemo/downscaled_clim
ate.pdf](http://gdo-
4 dcp.ucllnl.org/downscaled_cmip_projections/techmemo/downscaled_clim
5 ate.pdf).
- 6 RMA (Resource Management Associates, Inc.), 2010. *Numerical Modeling in*
7 *Support of Bay Delta Conservation Plan Technical Study #4 – Evaluation*
8 *of Tidal Marsh Restoration Effects Analysis*.
- 9 Sandhu, N., D. Wilson, R. Finch, and F. Chung. 1999. *Modeling Flow-Salinity*
10 *Relationships in the Sacramento-San Joaquin Delta Using Artificial*
11 *Neural Networks*. Technical Information Record OSP-99-1, Sacramento:
12 California Department of Water Resources.
- 13 Seneviratne, S., and S. Wu. 2007. Chapter 3: Enhanced Development of Flow-
14 Salinity Relationships in the Delta Using Artificial Neural Networks:
15 Incorporating Tidal Influence. *Methodology for Flow and Salinity*
16 *Estimates in the Sacramento-San Joaquin Delta and Suisun Marsh, 28th*
17 *Annual Progress Report to the State Water Resources Control Board*.
- 18 USACE (U.S. Army Corps of Engineers). 2011. *Sea-level Change Considerations*
19 *for Civil Works Programs*. Circular 1165-2-212. November.
- 20 _____ . 2013. *Incorporating Sea-level Change in Civil Works Programs*. Circular
21 1100-2-8162. 31 December.
- 22 USGCRP (U.S. Global Change Research Program). 2013. U.S. National Climate
23 Assessment (NCA) report. Available at: <http://ncadac.globalchange.gov/>
- 24 Vermeer, M., and S. Rahmstorf. 2009. Global sea level linked to global
25 temperatures. *Proceedings of the National Academy of Sciences*.
- 26 Wilbur, R., and A. Munévar. 2001. Chapter 7: Integration of CalSim and
27 Artificial Neural Networks Models for Sacramento-San Joaquin Delta
28 Flow-Salinity Relationships. *Methodology for Flow and Salinity Estimates*
29 *in the Sacramento-San Joaquin Delta and Suisun Marsh, 22nd Annual*
30 *Progress Report to the State Water Resources Control Board*.

1 **Appendix 5A, Section B**

2 **CalSim II and DSM2 Modeling**
3 **Simulations and Assumptions**

4 This section summarizes the modeling simulations and assumptions for the
5 No Action Alternative, Second Basis of Comparison, and Alternatives 1 through 5
6 in this Environmental Impact Statement (EIS). Appendix 5A, Section B, is
7 organized as follows:

- 8 • Introduction
- 9 • Assumptions for the No Action Alternative and Second Basis of Comparison
10 Model Simulations
 - 11 – No Action Alternative
 - 12 – Second Basis of Comparison
- 13 • Assumptions for Alternatives Model Simulations
 - 14 – Alternative 3
 - 15 – Alternative 5
 - 16 – Summary of Alternatives Assumptions
- 17 • Timeframe of Evaluation
- 18 • No Action Alternative and Second Basis of Comparison Assumptions Tables
 - 19 – CalSim II Assumptions
 - 20 – (DSM2 Assumptions)
- 21 • American River Demands
- 22 • Delivery Specifications
- 23 • U.S. Fish and Wildlife Service (USFWS) Reasonable and Prudent Alternative
24 (RPA) Implementation
- 25 • National Marine Fisheries Service (NMFS) RPA Implementation
- 26 • References

27 **5A.B1 Introduction**

28 As described in Appendix 5A, Section A, modeling was prepared for evaluation
29 of the alternatives considered in this EIS. This section describes the assumptions
30 for the CalSim II and DSM2 modeling of the No Action Alternative, Second
31 Basis of Comparison, and Alternatives 1 through 5.

32 The following model simulations were prepared as the basis for evaluating the
33 impacts of the other alternatives at 2030 projected conditions:

- 34 • No Action Alternative

- 1 • Second Basis of Comparison
- 2 • Alternative 1 – Same as the Second Basis of Comparison
- 3 • Alternative 2 – Only operational components of the No Action Alternative
- 4 (same modeling assumptions as the No Action Alternative)
- 5 • Alternative 3 –Discussed further in this section
- 6 • Alternative 4 – Similar to Second Basis of Comparison with actions to
- 7 improve aquatic resource conditions (same modeling assumptions as the
- 8 Second Basis of Comparison)
- 9 • Alternative 5 – Discussed further in this section

10 The No Action Alternative and Second Basis of Comparison assumptions were
11 developed by the Bureau of Reclamation (Reclamation). Alternative 2
12 assumptions were defined in the Notice of Intent. Assumptions for Alternatives 3,
13 4, and 5 were developed in consideration of comments received during the
14 scoping process.

15 The No Action Alternative and Second Basis of Comparison models were
16 developed by Reclamation. Other alternatives were simulated using these two
17 CalSim II simulations and implementing changes in assumptions from either the
18 No Action Alternative or the Second Basis of Comparison.

19 Alternative 1 and Alternative 4 modeling assumptions are the same as the Second
20 Basis of Comparison, and Alternative 2 modeling assumptions are the same as the
21 No Action Alternative; therefore, the assumptions for those alternatives will not
22 be discussed separately in this document.

23 CalSim II and DSM2 model representation of the RPAs in the 2008 USFWS and
24 2009 NMFS Biological Opinions (BOs) is consistent with the model
25 representation developed in 2009 through a coordinated process with the Federal
26 and state agencies.

27 **5A.B2 Assumptions for the No Action Alternative and** 28 **the Second Basis of Comparison Model** 29 **Simulations**

30 This section presents the assumptions used in developing the CalSim II and
31 DSM2 model simulations of the No Action Alternative and the Second Basis of
32 Comparison for use in the EIS evaluation.

33 The assumptions were selected to satisfy National Environmental Policy Act
34 requirements. The basis for these assumptions is described in Chapter 3,
35 Description of Alternatives. Assumptions that were applied to the CalSim II and
36 DSM2 modeling are included in the following section.

37 The No Action Alternative assumptions represent the continuation of existing
38 policy and management direction at Year 2030 and include implementation of

1 water operations components of the RPA actions specified in the 2008 USFWS
2 BO and 2009 NMFS BO.

3 The Second Basis of Comparison was developed due to the identified need during
4 scoping comments for a basis of comparison that would occur without the RPAs.
5 The Second Basis of Comparison assumptions do not include most of the RPAs.
6 They do, however, include actions that are constructed (e.g., Red Bluff Pumping
7 Plant), implemented (e.g., Suisun Marsh Habitat Management, Preservation, and
8 Restoration Plan), or legislatively mandated (e.g., San Joaquin River Restoration
9 Plan), and those that have undergone a substantial degree of progress (e.g., Yolo
10 Bypass Salmonid Habitat Restoration and Fish Passage).

11 The detailed assumptions used in developing CalSim II and DSM2 simulations of
12 the No Action Alternative and Second Basis of Comparison are included in
13 Section 5A.B.5. Additional information is provided in the table footnotes of each
14 table. Table entries and footnotes make reference to supporting appendix sections
15 and other documents.

16 **5A.B2.1 No Action Alternative**

17 The No Action Alternative was developed assuming projected Year 2030
18 conditions. The No Action Alternative assumptions include existing facilities and
19 ongoing programs that existed as of March 28, 2012, publication date of the
20 Notice of Intent. The No Action Alternative assumptions also include facilities
21 and programs that received approvals and permits by March 2012 because those
22 programs were consistent with the existing management direction of the Notice of
23 Intent. The No Action Alternative models do not include any potential future
24 habitat restoration areas due to the uncertainty on system effects depending on
25 potential locations of such areas within the Delta.

26 The No Action Alternative includes projected climate change and sea-level rise
27 assumptions corresponding to the Year 2030. Climate change results in the
28 changes in the reservoir and tributary inflows included in CalSim II. The sea-
29 level rise changes result in modified flow salinity relationships in the Delta. The
30 climate change and sea-level rise assumptions at Year 2030 are described in detail
31 in Section 5A.B.4. The CalSim II simulation for the No Action Alternative does
32 not consider any adaptation measures that would result in managing the Central
33 Valley Project (CVP) and State Water Project (SWP) system in a different manner
34 than it is managed today to reduce climate impacts. For example, future changes
35 in reservoir flood control reservation to better accommodate a seasonally
36 changing hydrograph may be considered under future programs, but are not
37 considered under the EIS.

38 **5A.B2.1.1 CalSim II Assumptions for the No Action Alternative Hydrology**

39 **5A.B2.1.1.1 Inflows/Supplies**

40 The CalSim II model includes the historical hydrology projected to Year 2030
41 under the climate change and with projected 2020 modifications for operations
42 upstream of the rim reservoirs.

1 *Level of Development*

2 CalSim II uses a hydrology that is the result of an analysis of agricultural and
 3 urban land use and population estimates. The assumptions used for Sacramento
 4 Valley land use result from aggregation of historical survey and projected data
 5 developed for the California Water Plan Update (Bulletin 160-98). Generally,
 6 land-use projections are based on Year 2020 estimates (hydrology serial number
 7 2020D09E); however, the San Joaquin Valley hydrology reflects draft 2030 land-
 8 use assumptions developed by Reclamation. Where appropriate, Year 2020
 9 projections of demands associated with water rights and CVP and SWP water
 10 service contracts have been included. Specifically, projections of full buildout are
 11 used to describe the American River region demands for water rights and CVP
 12 contract supplies, and California Aqueduct and the Delta Mendota Canal CVP and
 13 SWP contractor demands are set to full contract amounts.

14 *Demands, Water Rights, and CVP and SWP Contracts*

15 CalSim II demand inputs are preprocessed monthly time series for a specified
 16 level of development (e.g., 2020) and according to hydrologic conditions.
 17 Demands are classified as CVP project, SWP project, local project, or non-
 18 project. CVP and SWP demands are separated into different classes based on the
 19 contract type. A description of various demands and classifications included in
 20 CalSim II is provided in the 2008 Operations Criteria and Plan (OCAP)
 21 Biological Assessment (BA) Appendix D (Reclamation 2008a).

22 Table 5A.B.1 below includes the summary of the CVP and SWP project demands
 23 in thousand acre feet (TAF) included under the No Action Alternative. A detailed
 24 description of American River demands assumed under the No Action Alternative
 25 is provided in Section 5A.B.7. For SWP entitlement contractors, full Table A
 26 demands are assumed every year. The demand assumptions are not modified for
 27 changes in climate conditions.

28 The detailed listing of CVP and SWP contract amounts and other water rights
 29 assumptions for the No Action Alternative are included in the delivery
 30 specification tables in Section 5A.B.9.

31 **Table 5A.B.1 Summary of CVP and SWP Demands (TAF/Year) under No Action**
 32 **Alternative**

Project Contractor Type	North-of-the-Delta	South-of-the-Delta
CVP Contractors		
Settlement/Exchange	2,194	840
Water Service Contracts	935	2,101
Agriculture	378	1,937
M&I	557	164
Refuges	189	281
SWP Contractors		

Project Contractor Type	North-of-the-Delta	South-of-the-Delta
Feather River Service Area	983	–
Table A	114	4,055
Agriculture	0	1,017
M&I	114	3,038

1 Notes:

2 Urban demands noted above are for full buildout conditions.

3 M&I = municipal and industrial

4 **5A.B2.1.1.2 Facilities**

5 CalSim II includes representation of all the existing CVP and SWP storage and
 6 conveyance facilities. Assumptions regarding selected key facilities are included
 7 in the callout tables in Section 5A.B.5.

8 CalSim II also represents the flood control weirs such as the Fremont Weir
 9 located along the Sacramento River at the upstream end of the Yolo Bypass.
 10 Rating curves for the existing weir are used to model the spills over the Fremont
 11 Weir. In addition, the No Action Alternative CalSim II model assumes an
 12 operable weir notch for the Fremont Weir as modeled in Alternative 4 in the Bay
 13 Delta Conservation Plan (BDCP) Environmental Impact Report/Environmental
 14 Impact Statement (EIR/EIS) (DWR, Reclamation, USFWS, and NMFS 2013).

15 The No Action Alternative also includes the Freeport Regional Water Project,
 16 located along the Sacramento River near Freeport and the City of Stockton Delta
 17 Water Supply Project (30 million gallon/day [mgd] capacity).

18 A brief description of the key export facilities that are located in the Delta and
 19 included under the No Action Alternative run is provided below.

20 The Delta serves as a natural system of channels to transport river flows and
 21 reservoir storage to the CVP and SWP facilities in the south Delta, which export
 22 water to the projects’ contractors through two pumping plants: CVP’s C.W. Jones
 23 Pumping Plant and SWP’s Harvey O. Banks Pumping Plant. The Jones and
 24 Banks pumping plants supply water to agricultural and urban users throughout
 25 parts of the San Joaquin Valley, South Lahontan, Southern California, Central
 26 Coast, and South San Francisco Bay Area regions.

27 The Contra Costa Canal and the North Bay Aqueduct supply water to users in the
 28 northeastern San Francisco Bay and Napa Valley areas.

29 *Fremont Weir*

30 Fremont Weir is a flood control structure located along the Sacramento River at
 31 the head of the Yolo Bypass. To enhance the potential benefits of the Yolo
 32 Bypass for various fish species, the Fremont Weir is assumed to be notched to
 33 provide increased seasonal floodplain inundation in all of the alternatives
 34 simulated for the EIS. It is assumed that an opening in the existing weir and

1 operable gates are constructed at elevation 17.5 feet along with a smaller opening
2 and operable gates at elevation 11.5 feet. Derivation of the rating curve for the
3 elevation 17.5-foot opening used in the CalSim II model is described in
4 Section 5A.B.4 of this appendix. The modeling approach used in CalSim II
5 model to estimate the Fremont Weir spills using the daily patterned Sacramento
6 River flow at Verona is provided in Section 5A.3.3.

7 *CVP C.W. Bill Jones Pumping Plant (Tracy Pumping Plant) Capacity*

8 The Jones Pumping Plant consists of six pumps, including one rated at
9 800 cubic feet/second (cfs), two at 850 cfs, and three at 950 cfs. Maximum
10 pumping capacity is assumed to be 4,600 cfs with the 400 cfs Delta Mendota
11 Canal (DMC)–California Aqueduct Intertie that became operational in July 2012.

12 *SWP Banks Pumping Plant Capacity*

13 SWP Banks pumping plant has an installed capacity of about 10,668 cfs
14 (two units of 375 cfs, five units of 1,130 cfs, and four units of 1,067 cfs). The
15 SWP water rights for diversions specify a maximum of 10,350 cfs, but the U.S.
16 Army Corps of Engineers (USACE) permit for SWP Banks Pumping Plant allows
17 a maximum pumping of 6,680 cfs. With additional diversions depending on
18 Vernalis flows, the total diversion can go up to 8,500 cfs from December 15 to
19 March 15. Additional capacity of 500 cfs (pumping limit up to 7,180 cfs) is
20 allowed to reduce impact of NMFS BO Action 4.2.1 on the SWP.

21 *Contra Costa Water District (CCWD) Intakes*

22 The Contra Costa Canal originates at Rock Slough (about 4 miles southeast of
23 Oakley) and terminates after 47.7 miles, at Martinez Reservoir. Historically,
24 diversions at the unscreened Rock Slough facility (Contra Costa Canal Pumping
25 Plant No. 1) have ranged from about 50 to 250 cfs. The canal and associated
26 facilities are part of the CVP, but are operated and maintained by the Contra
27 Costa Water District (CCWD). CCWD also operates a diversion on Old River
28 and the Alternative Intake Project (AIP), the new drinking water intake at Victoria
29 Canal, about 2.5 miles east of CCWD’s intake on the Old River. CCWD can
30 divert water to the Los Vaqueros Reservoir to store good quality water when
31 available and supply to its customers.

32 **5A.B2.1.1.3 Regulatory Standards**

33 The regulatory standards that govern the operations of the CVP and SWP
34 facilities under the No Action Alternative are briefly described below. Specific
35 assumptions related to key regulatory standards are also outlined below.

36 *Decision 1641 (D-1641) Operations*

37 The State Water Resources Control Board (SWRCB) Water Quality Control Plan
38 (WQCP) and other applicable water rights decisions, as well as other agreements,
39 are important factors in determining the operations of both the CVP and SWP.

40 The December 1994 Accord committed the CVP and SWP to a set of Delta
41 habitat protective objectives that were incorporated into the 1995 WQCP and later
42 were implemented by Decision 1641 (D-1641). Significant elements in D-1641

1 include X2 standards, export/inflow (E/I) ratios, Delta water quality standards,
2 real-time Delta Cross Channel operation, and San Joaquin flow standards.

3 *Coordinated Operation Agreement (COA)*

4 The CVP and SWP use a common water supply in the Central Valley of
5 California. Reclamation and California Department of Water Resources (DWR)
6 have built water conservation and water delivery facilities in the Central Valley in
7 order to deliver water supplies to project contractors. The water rights of the
8 projects are conditioned by the SWRCB to protect the beneficial uses of water
9 within each respective project and jointly for the protection of beneficial uses in
10 the Sacramento Valley and the Sacramento-San Joaquin Delta Estuary. The
11 agencies coordinate and operate the CVP and SWP to meet the joint water right
12 requirements in the Delta.

13 The Coordinated Operation Agreement (COA), signed in 1986, defines the project
14 facilities and their water supplies, sets forth procedures for coordination of
15 operations, identifies formulas for sharing joint responsibilities for meeting Delta
16 standards as they existed in SWRCB Decision 1485 (D-1485), identifies how
17 unstored flow will be shared, sets up a framework for exchange of water and
18 services between the Projects, and provides for periodic review of the agreement.

19 *Central Valley Project Improvement Act (CVPIA) (b)(2) Assumptions*

20 The previous 2008 OCAP BA modeling included a dynamic representation of
21 Central Valley Project Improvement Act (CVPIA) 3406(b)(2) water allocation,
22 management, and related actions (B2). The selection of discretionary actions for
23 use of B2 water in each year was based on a May 2003 U.S. Department of the
24 Interior (the Department) policy decision. The use of B2 water is assumed to
25 continue in conjunction with the USFWS and NMFS BO RPA actions. The
26 CalSim II implementation used for modeling for the EIS does not dynamically
27 account for the use of (b)(2) water, but rather assumes predetermined USFWS BO
28 upstream fish objectives for Clear Creek, Sacramento River below Keswick Dam,
29 and American River below Nimbus Dam, and a pulse period exports limit. Other
30 (b)(2) actions are assumed to be accommodated by USFWS and NMFS BO RPA
31 actions for the American River, Stanislaus River, and Delta export restrictions.

32 *Continued CALFED Agreements*

33 The Environmental Water Account (EWA) was established in 2000 by the
34 CALFED Record of Decision (ROD). The EWA was initially identified as a
35 4-year cooperative effort intended to operate from 2001 through 2004, but was
36 extended through 2007 by agreement between the EWA agencies. It is uncertain,
37 however, whether the EWA will be in place in the future and what actions and
38 assets it may include. Because of this uncertainty, the EWA has not been
39 included in the current CalSim II implementation.

40 One element of the EWA available assets is the Lower Yuba River Accord
41 (LYRA) Component 1 water. In the absence of the EWA and implementation in
42 CalSim II, the LYRA Component 1 water is assumed to be transferred to south-
43 of-Delta SWP contractors to help mitigate the impact of the NMFS BO on SWP
44 exports during April and May. An additional 500 cfs of capacity is permitted at

1 Banks Pumping Plant from July through September to export this transferred
2 water.

3 *USFWS BO Actions*

4 The USFWS BO was released on December 15, 2008, in response to
5 Reclamation's request for formal consultation with the USFWS on the
6 coordinated operations of the CVP and SWP in California. To develop CalSim II
7 modeling assumptions for the RPA documented in this BO, DWR led a series of
8 meetings that involved members of fisheries and project agencies. This group has
9 prepared the assumptions and CalSim II implementations to represent the RPA in
10 the No Action Alternative CalSim II simulation. The following actions of the
11 USFWS BO RPA have been included in the No Action Alternative CalSim II
12 simulations:

- 13 • Action 1: Adult Delta Smelt migration and entrainment (RPA Component 1,
14 Action 1 – First Flush)
- 15 • Action 2: Adult Delta Smelt migration and entrainment (RPA Component 1,
16 Action 2)
- 17 • Action 3: Entrainment protection of larval and juvenile Delta Smelt (RPA
18 Component 2)
- 19 • Action 4: Estuarine habitat during Fall (RPA Component 3)
- 20 • Action 5: Temporary spring Head of Old River barrier (HORB) and the
21 Temporary Barrier Project (RPA Component 2)

22 A detailed description of the assumptions that have been used to model each
23 action is included in the technical memorandum "Representation of U.S. Fish and
24 Wildlife Service Biological Opinion Reasonable and Prudent Alternative Actions
25 for CalSim II Planning Studies," prepared by an interagency working group under
26 the direction of the lead agencies. Reference information for this technical
27 memorandum is included in Section 5A.B.10.

28 *NMFS BO Salmon Actions*

29 The NMFS Salmon BO on long-term operations of the CVP and SWP was
30 released on June 4, 2009. To develop CalSim II modeling assumptions for the
31 RPAs documented in this BO, DWR led a series of meetings that involved
32 members of fisheries and project agencies. This group has prepared the
33 assumptions and CalSim II implementations to represent the RPA in the No
34 Action Alternative CalSim II simulations for future planning studies. The
35 following NMFS BO RPAs have been included in the No Action Alternative
36 CalSim II simulations:

- 37 • Action I.1.1: Clear Creek spring attraction flows
- 38 • Action I.4: Wilkins Slough operations
- 39 • Action II.1: Lower American River flow management
- 40 • Action III.1.4: Stanislaus River flows below Goodwin Dam

- 1 • Action IV.1.2: Delta Cross Channel gate operations
- 2 • Action IV.2.1: San Joaquin River flow requirements at Vernalis and Delta
- 3 export restrictions
- 4 • Action IV.2.3: Old and Middle River flow management

5 For Action I.2.1, which calls for a percentage of years that meet certain specified
6 end-of-September and end-of-April storage and temperature criteria resulting
7 from the operation of Lake Shasta, no specific CalSim II modeling code is
8 implemented to simulate the performance measures identified.

9 A detailed description of the assumptions that have been used to model each
10 action is included in the technical memorandum “Representation of National
11 Marine Fisheries Service Biological Opinion Reasonable and Prudent Alternative
12 Actions for CalSim II Planning Studies,” prepared by an interagency working
13 group under the direction of the lead agencies. This technical memorandum is
14 included in the Section 5A.B.9.

15 *Water Transfers*

16 *Lower Yuba River Accord (LYRA)*

17 Acquisitions of Component 1 water under the Lower Yuba River Accord, and use
18 of 500 cfs dedicated capacity at Banks Pumping Plant from July to September are
19 assumed to be used to reduce as much of the impact of the April to May Delta
20 export actions on SWP contractors as possible.

21 *Phase 8 transfers*

22 Phase 8 transfers are not included in the No Action Alternative simulation.

23 *Short-term or Temporary Water Transfers*

24 Short-term or temporary transfers such as Sacramento Valley acquisitions
25 conveyed through Banks Pumping Plant are not included in the No Action
26 Alternative simulation.

27 **5A.B2.1.1.4 Specific Regulatory Assumptions**

28 *Lower American Flow Management*

29 The American River Flow Management Standard (ARFMS) is included in the
30 No Action Alternative, the Second Basis of Comparison, and all other alternatives
31 in the EIS (Reclamation 2006).

32 *Delta Outflow (Flow and Salinity)*

33 *SWRCB D-1641:*

34 All flow-based Delta outflow requirements per SWRCB D-1641 are included in
35 the No Action Alternative simulation. Similarly, for the February through June
36 period, the X2 standard is included in the No Action Alternative simulation.

37 *USFWS BO (December 2008) Action 4:*

38 USFWS BO Action 4 requires additional Delta outflow to manage X2 in the fall
39 months following Wet and Above Normal years to maintain an average X2 for
40 September and October no greater (more eastward) than 74 kilometers following

1 Wet years and 81 kilometers following Above Normal years. In November, the
2 inflow to CVP and SWP reservoirs in the Sacramento Basin should be added to
3 reservoir releases to provide an added increment of Delta inflow and to augment
4 Delta outflow up to the fall X2 target. This action is included in the No Action
5 Alternative.

6 *Combined Old and Middle River Flows*

7 USFWS BO restricts south Delta pumping to preserve certain Old and Middle
8 River (OMR) flows in three of its Actions: Action 1 to protect pre-spawning adult
9 Delta Smelt from entrainment during the first flush, Action 2 to protect
10 pre-spawning adults from entrainment and from adverse hydrodynamic
11 conditions, and Action 3 to protect larval Delta Smelt from entrainment. CalSim
12 II simulates these actions to a limited extent.

13 A brief description of USFWS BO Actions 1 through 3 implementations in
14 CalSim II is as follows: Action 1 is onset based on a turbidity trigger that takes
15 place during or after December. This action requires limit on exports so that the
16 average daily OMR flow is no more negative than -2,000 cfs for a total duration
17 of 14 days, with a 5-day running average no more negative than -2,500 cfs (within
18 25 percent of the monthly criteria). Action 1 ends after 14 days of duration or
19 when Action 3 is triggered based on a temperature criterion. Action 2 starts
20 immediately after Action 1 and requires a range of net daily OMR flows to be no
21 more negative than -1,250 to -5,000 cfs (with a 5-day running average within
22 25 percent of the monthly criteria). Action 2 continues until Action 3 is triggered.
23 Action 3 also requires net daily OMR flow to be no more negative than -1,250
24 to -5,000 cfs based on a 14-day running average (with a simultaneous 5-day
25 running average within 25 percent). Although the range is similar to Action 2, the
26 Action implementation is different. Action 3 continues until June 30, or when
27 water temperature reaches a certain threshold. A more detailed description of the
28 implementation of these actions is provided in Section 5A.B.8.

29 NMFS BO Action 4.2.3 requires OMR flow management to protect emigrating
30 juvenile winter-run, yearling spring-run, and Central Valley Steelhead within the
31 lower Sacramento and San Joaquin rivers from entrainment into south Delta
32 channels and at the export facilities in the south Delta. This action requires
33 reducing exports from January 1 through June 15 to limit negative OMR flows to
34 -2,500 to -5,000 cfs. CalSim II assumes OMR flows required in NMFS BO are
35 covered by OMR flow requirements developed for Actions 1 through 3 of the
36 USFWS BO as described in Section 5A.B.8.

37 *South Delta Export-San Joaquin River Inflow Ratio*

38 NMFS BO Action 4.2.1 requires exports to be capped at a certain fraction of
39 San Joaquin River flow at Vernalis during April and May while maintaining a
40 health and safety pumping of 1,500 cfs.

41 *Exports at the South Delta Intakes*

42 Exports at Jones and Banks Pumping Plant are restricted to their permitted
43 capacities per SWRCB D-1641 requirements. In addition, the south Delta exports
44 are subject to Vernalis flow-based export limits during April and May as required

1 by Action 4.2.1. An additional 500 cfs pumping is allowed to reduce the impact
2 of NMFS BO Action 4.2.1 on SWP during the July through September period.

3 Under D-1641 the combined export of the CVP Tracy Pumping Plant and SWP
4 Banks Pumping Plant is limited to a percentage of Delta inflow. The percentage
5 ranges from 35 to 45 percent during February (depending on the January eight
6 river index) and 35 percent during the months of March through June. For the
7 rest of the months, 65 percent of the Delta inflow is allowed to be exported.

8 A minimum health and safety pumping of 1,500 cfs is assumed from January
9 through June.

10 *Delta Water Quality*

11 The No Action Alternative simulation includes SWRCB D-1641 salinity
12 requirements. However, not all salinity requirements are included as CalSim II is
13 not capable of predicting salinities in the Delta. Instead, empirically based
14 equations and models are used to relate interior salinity conditions with the flow
15 conditions. DWR's Artificial Neural Network (ANN) is used to predict and
16 interpret salinity conditions at the Emmaton, Jersey Point, Rock Slough, and
17 Collinsville stations. Emmaton and Jersey Point standards are for protecting
18 water quality conditions for agricultural use in the western Delta, and they are in
19 effect from April 1 to August 15. The electrical conductivity (EC) requirement at
20 Emmaton varies from 0.45 millimhos per centimeter (mmhos/cm) to
21 2.78 mmhos/cm, depending on the water year type. The EC requirement at Jersey
22 Point varies from 0.45 to 2.20 mmhos/cm, depending on the water year type. The
23 Rock Slough standard is for protecting water quality conditions for municipal and
24 industrial (M&I) use for water exported through the Contra Costa Canal. It is a
25 year-round standard that requires a certain number of days in a year with chloride
26 concentration less than 150 milligrams per liter. The number of days requirement
27 is dependent upon the water year type. The Collinsville standard is applied during
28 October through May months to protect water quality conditions for migrating
29 fish species, and it varies between 12.5 mmhos/cm in May and 19.0 mmhos/cm in
30 October.

31 The sea-level rise change assumed at the Year 2030 results in a modified flow-
32 salinity relationship in the Delta. An ANN, which is capable of emulating DSM2
33 results under the 15-cm sea-level rise condition at the Year 2030 is used to
34 simulate the flow-salinity relationship in CalSim II simulation for the No Action
35 Alternative.

36 *San Joaquin River Restoration Program*

37 Friant Dam releases required by the San Joaquin River Restoration Program are
38 included in the No Action Alternative, the Second Basis of Comparison, and all
39 other alternatives. A more detailed description of the San Joaquin River
40 Restoration Program is presented in Appendix 3A, "No Action Alternative:
41 Central Valley Project and State Water Project Operations".

1 **5A.B2.1.1.5 Operations Criteria**

2 *Fremont Weir Operations*

3 To provide seasonal floodplain inundation in the Yolo Bypass, the 17.5- and the
4 11.5-foot elevation gates are opened between December 1 and March 31. This
5 may extend to May 15, depending on hydrologic conditions and measures to
6 minimize land use and ecological conflicts in the bypass. As a simplification for
7 modeling, the gates are assumed opened until April 30 in all years. The gates are
8 operated to limit maximum spill to 6,000 cfs until the Sacramento River stage
9 reaches the existing Fremont Weir crest elevation. When the river stage is at or
10 above the existing Fremont Weir crest elevation, the notch gates are assumed to
11 be closed. While desired inundation period is on the order of 30 to 45 days, gates
12 are not managed to limit to this range; instead, the duration of the event is
13 governed by the Sacramento River flow conditions. To provide greater
14 opportunity for the fish in the bypass to migrate upstream into the Sacramento
15 River, the 11.5-foot elevation gate is assumed to be open for an extended period
16 between September 15 and June 30. As a simplification for modeling, the period
17 of operation for this gate is assumed to be September 1 to June 30. The spills
18 through the 11.5-foot elevation gate are limited to 100 cfs.

19 *Delta Cross Channel Gate Operations*

20 SWRCB D-1641 Delta Cross Channel (DCC) standards provide for closure of the
21 DCC gates for fisheries protection at certain times of the year. From November
22 through January, the DCC may be closed for up to 45 days. From February 1
23 through May 20, the gates are closed every day. The gates may also be closed for
24 14 days during the May 21 through June 15 time period. Reclamation determines
25 the timing and duration of the closures after discussion with USFWS, California
26 Department of Fish and Wildlife (DFW), and NMFS.

27 NMFS BO Action 4.1.2 requires gates to be operated as described in the BO
28 based on the presence of salmonids and water quality from October 1 through
29 December 14; gates should be closed from December 15 to January 31, except
30 short-term operations to maintain water quality. CalSim II includes the NMFS
31 BO DCC gate operations in addition to the D-1641 gate operations. When the
32 daily flows in the Sacramento River at Wilkins Slough exceed 7,500 cfs (flow
33 assumed to flush salmon into the Delta), DCC is closed for a certain number of
34 days in a month as described in Section B-11. From October 1 to December 14, if
35 the flow trigger condition is such that additional days of DCC gates closure is
36 called for, however water quality conditions are a concern and the DCC gates
37 remain open, then Delta exports are limited to 2,000 cfs for each day in question.

38 *Allocation Decisions*

39 CalSim II includes allocation logic for determining deliveries to north-of-Delta
40 and south-of-Delta CVP and SWP contractors. The delivery logic uses runoff
41 forecast information, which incorporates uncertainty in the hydrology and
42 standardized rule curves (i.e. Water Supply Index versus Demand Index Curve).
43 The rule curves relate forecasted water supplies to deliverable “demand,” and then
44 use deliverable “demand” to assign subsequent delivery levels to estimate the

1 water available for delivery and carryover storage. Updates of delivery levels
 2 occur monthly from January 1 through May 1 for the SWP and March 1 through
 3 May 1 for the CVP as runoff forecasts become more certain. The south-of-Delta
 4 SWP delivery is determined based on water supply parameters and operational
 5 constraints. The CVP system wide delivery and south-of-Delta delivery are
 6 determined similarly upon water supply parameters and operational constraints
 7 with specific consideration for export constraints.

8 *San Luis Operations*

9 CalSim II sets targets for San Luis storage each month that are dependent on the
 10 current South-of-Delta allocation and upstream reservoir storage. When upstream
 11 reservoir storage is high, allocations and San Luis fill targets are increased.
 12 During a prolonged drought when upstream storage is low, allocations and fill
 13 targets are correspondingly low. For the No Action Alternative simulation, the
 14 San Luis rule curve is managed to minimize situations in which shortages may
 15 occur due to lack of storage or exports.

16 *New Melones Operations*

17 In addition to flood control, New Melones is operated for four different purposes:
 18 fishery flows, water quality, Bay-Delta flow, and water supply.

19 *Fishery*

20 In the No Action Alternative simulation, fishery flows refer to flow requirements
 21 of the 2009 NMFS BO Action III.1.3. These flows are patterned to provide fall
 22 attraction flows in October and outmigration pulse flows in spring months
 23 (April 15 through May 15 in all years), and total up to 98.9 TAF to 589.5 TAF
 24 annually depending on the hydrological conditions based on the New Melones
 25 water supply forecast (the end-of-February New Melones Storage, plus the March
 26 through September forecast of inflow to the reservoir) (Tables 5A.B.2 through
 27 5A.B.4).

28 **Table 5A.B.2 Annual Fishery Flow Allocation in New Melones**

New Melones Water Supply Forecast (TAF)	Fishery Flows (TAF)
0 to 1,399.9	185.3
1,400 to 1,999.9	234.1
2,000 to 2,499.9	346.7
2,500 to 2,999.9	483.7
≥ 3,000	589.5

1 **Table 5A.B.3 Monthly “Base” Flows for Fisheries Purposes Based on the Annual**
 2 **Fishery Volume**

Annual Fishery Flow Volume (TAF)	Monthly Fishery Base Flows (cfs)											
	Oct.	Nov.	Dec.	Jan.	Feb.	Mar.	Apr. 1-15	May 16-31	June	July	Aug.	Sept.
98.9	110	200	200	125	125	125	250	250	0	0	0	0
185.3	577.4	200	200	212.9	214.3	200	200	150	150	150	150	150
234.1	635.5	200	200	219.4	221.4	200	500	284.4	200	200	200	200
346.7	774.2	200	200	225.8	228.6	200	1,471.4	1,031.3	363.3	250	250	250
483.7	796.8	200	200	232.3	235.7	1,521	1,614.3	1,200	940	300	300	300
589.5	841.9	300	300	358.1	364.3	1,648.4	2,442.9	1,725	1,100	429	400	400

3 **Table 5A.B.4 April 15 through May 15 “Pulse” Flows for Fisheries Purposes Based**
 4 **on the Annual Fishery Volume**

Annual Fishery Flow Volume (TAF)	Fishery Pulse Flows (cfs)	Fishery Pulse Flows (cfs)
	April 15-30	May 1-15
185.3	687.5	666.7
234.1	1,000.0	1,000.0
346.7	1,625.0	1,466.7
483.7	1,212.5	1,933.3
589.5	925.0	2,206.7

5 *Water Quality*

6 Water quality releases include releases to meet the SWRCB D-1641 salinity
 7 objectives at Vernalis and the Decision 1422 (D-1422) dissolved oxygen
 8 objectives at Ripon.

9 The Vernalis water quality requirement (SWRCB D-1641) is an EC requirement
 10 of 700 and 1000 mmhos/cm for the irrigation (April through August) and
 11 non-irrigation (September through March) seasons, respectively.

12 Additional releases are made to the Stanislaus River below Goodwin Dam if
 13 necessary, to meet the D-1422 dissolved oxygen content objective. Surrogate
 14 flows representing releases for dissolved oxygen requirement in CalSim II are
 15 presented in Table 5A.B.5. The surrogate flows are reduced for critical years
 16 where New Melones water supply forecast (the end-of-February New Melones
 17 Storage, plus the March through September forecast of inflow to the reservoir) is
 18 less than 940 TAF. These flows are met through releases from New Melones
 19 without any annual volumetric limit.

1 **Table 5A.B.5 Surrogate Flows for D1422 DO Requirement at Vernalis (TAF)**

	Non-Critical Years	Critical Years
January	0.0	0.0
February	0.0	0.0
March	0.0	0.0
April	0.0	0.0
May	0.0	0.0
June	15.2	11.9
July	16.3	12.3
August	17.4	12.3
September	14.8	11.9
October	0.0	0.0
November	0.0	0.0
December	0.0	0.0

2 *Bay-Delta Flows*

3 Bay-Delta flow requirements are defined by D-1641 flow requirements at
 4 Vernalis (not including pulse flows during the April 15 through May 16 period).
 5 These flows are met through releases from New Melones without any annual
 6 volumetric limit.

7 D-1641 requires the flow at Vernalis to be maintained during the February
 8 through June period. The flow requirement is based on the required location
 9 of X2 and the San Joaquin Valley water year hydrologic classification
 10 (60-20-20 Index), as summarized in Table 5A.B.6.

11 **Table 5A.B.6 Bay-Delta Vernalis Flow Objectives (average monthly cfs)**

60-20-20 Index	Flow Required if X2 is West of Chippys Island	Flow required if X2 is East of Chippys Island
Wet	3,420	2,130
Above Normal	3,420	2,130
Below Normal	2,280	1,420
Dry	2,280	1,420
Critical	1,140	710

12 *Water Supply*

13 Water supply refers to deliveries from New Melones to water rights holders
 14 (Oakdale Irrigation District [ID] and South San Joaquin ID) and CVP eastside
 15 contractors (Stockton East Water District [WD] and Central San Joaquin Water
 16 Control District [WCD]).

1 Water is provided to Oakdale ID and South San Joaquin ID in accordance with
 2 their 1988 Settlement Agreement with Reclamation (up to 600 TAF based on
 3 hydrologic conditions), limited by consumptive use. The conservation account of
 4 up to 200 TAF storage capacity defined under this agreement is not modeled in
 5 CalSim II.

6 *Water Supply-CVP Eastside Contractors*

7 Annual allocations are determined using New Melones water supply forecast (the
 8 end-of-February New Melones Storage, plus the March through September
 9 forecast of inflow to the reservoir) for Stockton East WD and Central San Joaquin
 10 WCD (Table 5A.B.7) and are distributed throughout 1 year using monthly
 11 patterns.

12 **Table 5A.B.7 CVP Contractor Allocations**

New Melones Water Supply Forecast (TAF)	CVP Contractor Allocation (TAF)
<1,400	0
1,400 to 1,800	49
>1,800	155

13 **5A.B2.1.2 DSM2 Assumptions for No Action Alternative**

14 **5A.B2.1.2.1 River Flows**

15 For the No Action Alternative DSM2 simulation, the river flows at the DSM2
 16 boundaries are based on the monthly flow time series from CalSim II.

17 **5A.B2.1.2.2 Tidal Boundary**

18 For the No Action Alternative, the tidal boundary condition at Martinez is based
 19 on an adjusted astronomical tide normalized for sea-level rise (Ateljevich and
 20 Yu 2007) and is modified to account for the sea-level rise using the correlations
 21 derived based on three-dimensional (UnTRIM) modeling of the Bay-Delta with
 22 sea-level rise at Year 2030.

23 **5A.B2.1.2.3 Water Quality**

24 *Martinez EC*

25 For the No Action Alternative, the Martinez EC boundary condition in the DSM2
 26 planning simulation is estimated using the G-model based on the net Delta
 27 outflow simulated in CalSim II and the pure astronomical tide (Ateljevich 2001),
 28 as modified to account for the salinity changes related to the sea-level rise using
 29 the correlations derived based on the three-dimensional (UnTRIM) modeling of
 30 the Bay-Delta with sea-level rise at Year 2030.

1 *Vernalis EC*

2 For the No Action Alternative DSM2 simulation, the Vernalis EC boundary
3 condition is based on the monthly San Joaquin EC time series estimated in
4 CalSim II.

5 **5A.B2.1.2.4 Morphological Changes**

6 No additional morphological changes were assumed as part of the No Action
7 Alternative simulation. The DSM2 model and grid developed as part of the 2009
8 recalibration effort (DWR 2009) was used for the No Action Alternative
9 modeling.

10 **5A.B2.1.2.5 Facilities**11 *Delta Cross Channel*

12 DCC gate operations are modeled in DSM2. The number of days in a month the
13 DCC gates are open is based on the monthly time series from CalSim II.

14 *South Delta Temporary Barriers*

15 South Delta Temporary Barriers are included in the No Action Alternative
16 simulation. The three agricultural temporary barriers located on Old River,
17 Middle River, and Grant Line Canal are included in the model. The fish barrier
18 located at the Head of Old River is also included in the model.

19 *Clifton Court Forebay Gates*

20 Clifton Court Forebay gates are operated based on the Priority 3 operation, where
21 the gate operations are synchronized with the incoming tide to minimize the
22 impacts to low water levels in nearby channels. The Priority 3 operation is
23 described in the 2008 OCAP BA Appendix F Section 5.2 (Reclamation 2008b).

24 **5A.B2.1.2.6 Operations Criteria**25 *South Delta Temporary Barriers*

26 South Delta Temporary Barriers are operated based on San Joaquin flow
27 conditions. Head of Old River Barrier is assumed to be only installed from
28 September 16 to November 30 and is not installed in the spring months, based on
29 the USFWS BO Action 5. The agricultural barriers on Old and Middle Rivers are
30 assumed to be installed starting from May 16, and the one on Grant Line Canal
31 from June 1. All three agricultural barriers are allowed to operate until
32 November 30. The tidal gates on Old and Middle River agricultural barriers are
33 assumed to be tied open from May 16 to May 31.

34 *Montezuma Salinity Control Gate*

35 The radial gates in the Montezuma Slough Salinity Control Gate Structure are
36 assumed to be tidally operating from October through February each year to
37 minimize propagation of high salinity conditions into the interior Delta.

38 **5A.B2.2 Second Basis of Comparison**

39 The Second Basis of Comparison was developed assuming projected Year 2030
40 conditions. The Second Basis of Comparison assumptions include CVP and SWP

1 operations prior to the RPAs, except for the ones that are constructed (e.g., Red
2 Bluff Pumping Plant), implemented, legislatively mandated (e.g., San Joaquin
3 River Restoration Plan), or that have undergone a substantial degree of progress
4 (e.g., Yolo Bypass Salmonid Habitat and Fish Passage). Similar to the No Action
5 Alternative, the Second Basis of Comparison models do not include any potential
6 future habitat restoration areas due to the uncertainty of system effects depending
7 on potential locations of such areas within the Delta.

8 The Second Basis of Comparison includes projected climate change and sea-level
9 rise assumptions corresponding to the Year 2030. Change in climate results in the
10 changes in the reservoir and tributary inflows are included in CalSim II. The
11 sea-level rise changes result in modified flow-salinity relationships in the Delta.
12 The climate change and sea-level rise assumptions at Year 2030 are described in
13 detail in Section 5A.B.2. CalSim II simulation of the Second Basis of
14 Comparison does not consider any adaptation measures that would result in
15 managing the CVP and SWP system in a different manner than today to reduce
16 climate impacts. For example, future changes in reservoir flood control
17 reservation to better accommodate a seasonally changing hydrograph may be
18 considered under future programs, but are not considered under the EIS.

19 **5A.B.2.2.1 CalSim II Assumptions for Second Basis of Comparison**

20 **5A.B.2.2.1.1 Hydrology**

21 *Inflows/Supplies*

22 Consistent with the No Action Alternative simulation.

23 *Level of Development*

24 Consistent with the No Action Alternative simulation.

25 *Demands, Water Rights, CVP and SWP Contracts*

26 Consistent with the No Action Alternative simulation.

27 **5A.B.2.2.1.2 Facilities**

28 Facilities assumptions under the Second Basis of Comparison are consistent with
29 the No Action Alternative simulation.

30 *Fremont Weir*

31 Consistent with the No Action Alternative simulation.

32 *CVP C.W. Bill Jones Pumping Plant (Tracy Pumping Plant) Capacity*

33 Consistent with the No Action Alternative simulation.

34 *SWP Banks Pumping Plant (Banks Pumping Plant) Capacity*

35 Consistent with the No Action Alternative simulation.

36 *CCWD Intakes*

37 Consistent with the No Action Alternative simulation.

1 **5A.B2.2.1.3 Regulatory Standards**

2 The regulatory standards that govern the operations of the CVP and SWP
3 facilities under the Second Basis of Comparison are briefly described below.
4 Specific assumptions related to key regulatory standards are also outlined below.

5 *D-1641 Operations*

6 D-1641 Operations simulated under the Second Basis of Comparison are
7 consistent with the No Action Alternative simulation.

8 Significant elements of D-1641 include X2 standards, E/I ratios, Delta water
9 quality standards, real-time Delta Cross Channel operation, and San Joaquin flow
10 standards.

11 *Coordinated Operation Agreement (COA)*

12 Consistent with the No Action Alternative simulation.

13 *CVPIA (b)(2) Assumptions*

14 Consistent with the No Action Alternative simulation.

15 *Continued CALFED Agreements*

16 Consistent with the No Action Alternative simulation.

17 *USFWS BO Actions*

18 The 2008 USFWS BO RPAs are not implemented under the Second Basis of
19 Comparison.

20 *NMFS BO Actions*

21 The 2009 NMFS BO RPAs are not implemented under the Second Basis of
22 Comparison.

23 *Water Transfers*

24 Water transfers assumptions simulated under the Second Basis of Comparison are
25 consistent with the No Action Alternative simulation.

26 **5A.B2.2.1.4 Specific Regulatory Assumptions**

27 *Lower American Flow Management*

28 Consistent with the No Action Alternative simulation.

29 *Delta Outflow (Flow and Salinity)*

30 *SWRCB D-1641*

31 Consistent with the No Action Alternative simulation.

32 *USFWS BO (December 2008) Action 4*

33 USFWS BO Action 4 is not included under the Second Basis of Comparison.

34 *Combined Old and Middle River Flows*

35 No requirement for minimum combined Old and Middle River flows is included
36 in the Second Basis of Comparison.

1 *South Delta Export-San Joaquin River Inflow Ratio*

2 NMFS BO Action 4.2.1 requires exports to be capped at a certain fraction of San
3 Joaquin River flow at Vernalis during April and May while maintaining a health
4 and safety pumping of 1,500 cfs.

5 *Exports at the South Delta Intakes*

6 The Second Basis of Comparison, similar to the No Action Alternative, includes
7 export restrictions at Jones and Banks Pumping Plant per SWRCB D-1641
8 requirements.

9 Under D-1641, the combined export of the CVP Tracy Pumping Plant and SWP
10 Banks Pumping Plant is limited to a percentage of Delta inflow. The percentage
11 ranges from 35 percent to 45 percent during February depending on the January
12 eight river index and is 35 percent during March through June months. For the
13 rest of the months, 65 percent of the Delta inflow is allowed to be exported.

14 Further limitations on south Delta exports due to NMFS BO Action 4.2.1 are not
15 included under the Second Basis of Comparison.

16 A minimum health and safety pumping of 1,500 cfs is assumed from January
17 through June.

18 *Delta Water Quality*

19 Consistent with the No Action Alternative simulation.

20 The sea-level rise change assumed at the Year 2030 results in a modified flow-
21 salinity relationship in the Delta. An ANN, which is capable of emulating the
22 DSM2 model results under the 15-cm sea-level rise condition at the Year 2030, is
23 used to simulate the flow-salinity relationship in CalSim II simulation for the
24 Second Basis of Comparison.

25 *San Joaquin River Restoration Program*

26 Consistent with the No Action Alternative simulation.

27 **5A.B2.2.1.5 Operations Criteria**

28 *Fremont Weir Operations*

29 Consistent with the No Action Alternative simulation.

30 *Delta Cross Channel Gate Operations*

31 SWRCB D-1641 DCC standards provide for closure of the DCC gates for
32 fisheries protection at certain times of the year. From November through January,
33 the DCC may be closed for up to 45 days. From February 1 through May 20, the
34 gates are closed. The gates may also be closed for 14 days during the May 21
35 through June 15 time period. Reclamation determines the timing and duration of
36 the closures after discussion with USFWS, California Department of Fish and
37 Wildlife (DFW), and NMFS.

38 The NMFS BO Action 4.1.2 that specifies DCC operations is not included in the
39 Second Basis of Comparison.

1 *Allocation Decisions*

2 The rules and assumptions used for allocation decisions under the Second Basis of
3 Comparison are consistent with the No Action Alternative simulation.

4 *San Luis Operations*

5 The rules and assumptions used for San Luis operations under the Second Basis
6 of Comparison are consistent with the No Action Alternative simulation.

7 *New Melones Operations*

8 In addition to flood control, New Melones is operated for four different purposes:
9 fishery flows, water quality, Bay-Delta flow, and water supply.

10 *Fishery*

11 Because the Second Basis of Comparison represents regulatory environment prior
12 to the 2008 USFWS and 2009 NMFS BOs, fishery flows in this simulation refer
13 to flow requirements of the 1997 New Melones Interim Plan of Operations (IPO).
14 These flows include an outmigration pulse flow in April and May. Total annual
15 volume dedicated to fishery flows vary from 0 to 467 TAF depending on the
16 hydrologic conditions defined by the New Melones water supply forecast (the
17 end-of-February New Melones Storage, plus the March through September
18 forecast of inflow to the reservoir) (Tables 5A.B.8 through 5A.B.10).

19 **Table 5A.B.8 Annual Fishery Flow Allocation in New Melones**

New Melones Water Supply Forecast (TAF)	Fishery Flows (TAF)
0	0
1,400	98
2,000	125
2,500	345
3,000	467
6,000	467

20 **Table 5A.B.9 Monthly “Base” Flows for Fisheries Purposes Based on the Annual**
21 **Fishery Volume**

Annual Fishery Flow Volume (TAF)	Monthly Fishery Base Flows (cfs)											
	Oct.	Nov.	Dec.	Jan.	Feb.	Mar.	Apr. 1-15	May 16-31	June	July	Aug.	Sept.
98.4	110	200	200	125	125	125	250	250	0	0	0	0
243.3	200	250	250	250	250	250	300	300	200	200	200	200
253.8	250	275	275	275	275	275	300	300	200	200	200	200
310.3	250	300	300	300	300	300	900	900	250	250	250	250
410.2	350	350	350	350	350	350	1,500	1,500	800	300	300	300
466.8	350	400	400	400	400	400	1,500	1,500	1,500	300	300	300

1 **Table 5A.B.10 April 15 through May 15 “Pulse” Flows for Fisheries Purposes**
 2 **Based on the Annual Fishery Volume**

Annual Fishery Flow Volume (TAF)	Fishery Pulse Flows (CFS) April 15 – May 15
0	0
98	500
125	1,500
345	1,500
467	1,500
467	1,500

3 *Water Quality*

4 Consistent with the No Action Alternative simulation.

5 *Bay-Delta Flows*

6 Consistent with the No Action Alternative simulation.

7 *Water Supply*

8 Consistent with the No Action Alternative simulation.

9 *Water Supply-CVP Eastside Contractors*

10 Consistent with the No Action Alternative simulation.

11 **5A.B2.2.2 DSM2 Assumptions for Second Basis of Comparison**

12 **5A.B2.2.2.1 River Flows**

13 Consistent with the No Action Alternative simulation.

14 **5A.B2.2.2.2 Tidal Boundary**

15 Consistent with the No Action Alternative simulation.

16 **5A.B2.2.2.3 Water Quality**

17 *Martinez EC*

18 Consistent with the No Action Alternative simulation.

19 *Vernalis EC*

20 Consistent with the No Action Alternative simulation.

21 **5A.B2.2.2.4 Morphological Changes**

22 Consistent with the No Action Alternative simulation.

23 **5A.B2.2.2.5 Facilities**

24 *Delta Cross Channel*

25 Delta Cross Channel gate operations are modeled in DSM2. The number of days
 26 in a month the DCC gates are open is based on the monthly time series from

1 CalSim II. DCC gate operations in Second Basis of Comparison are different
 2 than those in the No Action Alternative simulation as described previously in this
 3 section.

4 *South Delta Temporary Barriers*

5 South Delta Temporary Barriers are included similar to the No Action
 6 Alternative. However, the operation of the HORB is different in the Second Basis
 7 of Comparison as explained in the following section.

8 *Clifton Court Forebay Gates*

9 Consistent with the No Action Alternative simulation.

10 **5A.B2.2.2.6 Operations Criteria**

11 *South Delta Temporary Barriers*

12 Similar to the No Action Alternative simulation with the exception that the
 13 USFWS BO Action 5 is not included in the Second Basis of Comparison.
 14 Therefore, HORB is installed in spring months (April 1 through May 31) in
 15 addition to fall months (September 16 through November 30).

16 *Montezuma Salinity Control Gate*

17 Consistent with the No Action Alternative simulation.

18 **5A.B3 Assumptions for Alternatives Model**
 19 **Simulations**

20 This section describes the CalSim II and DSM2 modeling assumptions for the
 21 Alternatives 3 and 5. Alternative 3 is generally consistent with the Second Basis
 22 of Comparison, and Alternative 5 is generally consistent with the No Action
 23 Alternative. Assumptions that are different from the Second Basis of Comparison
 24 for Alternative 3 and from the No Action Alternative for Alternative 5 are
 25 described in detail below. Other assumptions that are consistent with the
 26 respective basis of comparison, are provided in short form for completeness.

27 CVP and SWP operational assumptions are identical under the No Action
 28 Alternative and Alternative 2; and under the Second Basis of Comparison and
 29 Alternatives 1 and 4. Therefore, separate discussions related to assumptions for
 30 Alternatives 1, 2, and 4 are not included in this appendix.

31 **5A.B3.1 Alternative 3**

32 Alternative 3 model assumptions generally follow the Second Basis of
 33 Comparison simulation with the exception of the Old and Middle River Flows
 34 requirement, and a different set of assumptions for the New Melones operation
 35 that are based on the Oakdale ID's 2012 proposal [OID et al. 2012]. Alternative
 36 3 includes other assumptions that are not modeled such as predation control, trap
 37 and haul fish passage, trap at head of Old River and barge to Chipps Island, and
 38 ocean harvest limits for Central Valley Chinook Salmon. Detailed descriptions of

1 Alternative 3 assumptions are described in the Chapter 3, Description of
2 Alternatives.

3 Alternative 3 CalSim II and DSM2 assumptions that are different from the Second
4 Basis of comparison are described below.

5 **5A.B3.1.1 CalSim II Assumptions for Alternative 3**

6 **5A.B3.1.1.1 Demands, Water Rights, CVP and SWP Contracts**

7 Similar to the Second Basis of Comparison and the No Action Alternative.

8 **5A.B3.1.1.2 Facilities**

9 *Fremont Weir*

10 Consistent with the Second Basis of Comparison and the No Action Alternative.

11 *Banks Pumping Plant Capacity*

12 Consistent with the Second Basis of Comparison and the No Action Alternative.

13 *Jones Pumping Plant Capacity*

14 Consistent with the Second Basis of Comparison and the No Action Alternative.

15 **5A.B3.1.1.3 Regulatory Standards**

16 *Delta Outflow Index (Flow and Salinity)*

17 *SWRCB D-1641*

18 Consistent with the Second Basis of Comparison and the No Action Alternative.

19 *USFWS BO Action 4*

20 Consistent with the Second Basis of Comparison.

21 *Combined Old and Middle River Flows*

22 The combined Old and Middle River (OMR) flow criteria are based on concepts
23 addressed in the 2008 USFWS and 2009 NMFS BOs related to adaptive
24 restrictions for temperature, turbidity, salinity, and presence of Delta Smelt. The
25 OMR flow criteria in the Alternative 3 are similar to those of the No Action
26 Alternative, with the exception of the following changes:

- 27 • Action 1 that protects the pre-spawning adult Delta Smelt from entrainment is
28 modified to limit exports such that the average daily OMR flow is no more
29 negative than -3,500 cfs for a total duration of 14 days, with a 5-day running
30 average no more negative than 4,375 cfs (within 25 percent of the monthly
31 criteria).
- 32 • Action 2 that protects adult Delta Smelt within the Delta from entrainment is
33 modified to limit exports so that the average daily OMR flow is no more
34 negative than -3,500 or -7,500 cfs depending on the previous month's ending
35 X2 location (-3,500 cfs if X2 is east of Roe Island, or -7,500 cfs if X2 is west
36 of Roe Island), with a 5-day running average within 25 percent of the monthly
37 criteria (no more negative than -4,375 cfs if X2 is east of Roe Island,
38 or -9,375 cfs if X2 is west of Roe Island).

- 1 • Action 3 that protects larval and juvenile Delta Smelt from entrainment is
 2 modified to limit exports so that the average daily OMR flow is no more
 3 negative than -1,250, 3,500, or 7,500 cfs, depending on the previous month's
 4 ending X2 location (-1,250 cfs if X2 is east of Chipps Island, -7,500 cfs if X2
 5 is west of Roe Island, or -3,500 cfs if X2 is between Chipps and Roe Island,
 6 inclusively), with a 5-day running average within 25 percent of the monthly
 7 criteria (no more negative than -1,562 cfs if X2 is east of Chipps Island,
 8 -9,375 cfs if X2 is west of Roe Island, or -4,375 cfs if X2 is between Chipps
 9 and Roe Island).
- 10 • Temporal off-ramp for Action 3 is assumed to occur no later than June 15
 11 (changed from June 30).
- 12 • An off-ramp based on QWest (westerly flow on the San Joaquin River past
 13 Jersey Point calculated as a combination of San Joaquin River at Blind Point,
 14 Three Mile Slough and Dutch Slough) is assumed. If Qwest is greater than
 15 12,000 cfs, then the Action 3 is discontinued. Because Action 2 is defined to
 16 occur between Actions 1 and 3, the Qwest off ramp also results in
 17 discontinuation of Action 2 if it happens before Action 3 is triggered. In
 18 monthly CalSim II modeling, the previous month's QWest value is used for
 19 determining the off-ramp, therefore if the off-ramp occurs within the previous
 20 month, RPA Actions in that previous month are assumed to continue until the
 21 end of the month.

22 *South Delta Export-San Joaquin River Inflow Ratio*

23 Consistent with the Second Basis of Comparison.

24 *Exports at the South Delta Intakes*

25 The south Delta exports in Alternative 3 are operated per SWRCB D-1641.
 26 Similar to the Second Basis of comparison, the combined export of the CVP
 27 Tracy Pumping Plant and SWP Banks Pumping Plant is limited to a percentage of
 28 the total Delta inflow, based on the export-inflow ratio specified under D-1641.

29 *Delta Water Quality*

30 Alternative 3 includes SWRCB D-1641 salinity requirements consistent with the
 31 Second Basis of Comparison and the No Action Alternative.

32 *San Joaquin River Restoration Program*

33 Consistent with the No Action Alternative simulation.

34 **5A.B3.1.1.4 Operations Criteria**

35 *Fremont Weir Operations*

36 Consistent with the Second Basis of Comparison and the No Action Alternative.

37 *Delta Cross Channel Gate Operations*

38 Consistent with the Second Basis of Comparison.

1 *Allocation Decisions*

2 The rules and assumptions used for determining the allocations in the
 3 Alternative 3 CalSim II simulation are similar to the No Action Alternative
 4 simulation.

5 *San Luis Operations*

6 The rules and assumptions used for San Luis operations under the Alternative 3
 7 are consistent with the No Action Alternative and the Second Basis of
 8 Comparison simulations.

9 *New Melones Operations*

10 In addition to flood control, New Melones is operated for four different purposes:
 11 fishery flows, water quality, Bay-Delta flow, and water supply.

12 *Fishery*

13 In the Alternative 3 simulation, fishery flows are modeled per Oakdale Irrigation
 14 District’s 2012 proposal (OID et al. 2012). These flows include an outmigration
 15 pulse flow from April 1 through May 15. Total annual volume dedicated to
 16 fishery flows vary from 174 to 318 TAF depending on the hydrologic conditions
 17 defined by the New Melones water supply forecast (the end-of-February New
 18 Melones Storage, plus the March through September forecast of inflow to the
 19 reservoir) (Tables 5A.B.11 through 5A.B.13).

20 **Table 5A.B.11 Annual Fishery Flow Allocation in New Melones**

New Melones Water Supply Forecast (TAF)	Fishery Base Flows (TAF)
0 to 1,800	174
1,801 to 2,500	235
>2,500	318

21 **Table 5A.B.12 Monthly “Base” Flows for Fisheries Purposes Based on the Annual**
 22 **Fishery Volume**

Annual Fishery Flow Volume (TAF)	Monthly Fishery Base Flows (cfs)											
	Oct.	Nov.	Dec.	Jan.	Feb.	Mar.	Apr.	May	June	July	Aug.	Sept.
235	252	300	300	150	173	200	200	200	200	200	200	200
318	300	300	300	300	300	300	1,500	850	200	200	200	200

1 **Table 5A.B.13 April 1 through May 31 “Pulse” Flows for Fisheries Purposes Based**
 2 **on the Annual Fishery Volume**

New Melones Water Supply Forecast (TAF)	Fishery Pulse Flows (CFS) April 1–May 31
0 to 1,800	750
1,801 to 2,500	1,500
>2,500	1,500

3 *Water Quality*

4 No D-1641 water quality releases are assumed in Alternative 3.

5 D-1422 dissolved oxygen compliance point is moved to the Orange Blossom
 6 Bridge under the Alternative 3. However, for modeling purposes, surrogate flows
 7 in CalSim II are assumed to be the same as those to meet the Ripon compliance
 8 point (surrogate flows consistent with the Second Basis of Comparison and the
 9 No Action Alternative).

10 *Bay-Delta Flows*

11 No D-1641 Bay-Delta flow requirements are assumed under the Alternative 3.

12 *Water Supply*

13 Water supply refers to deliveries from New Melones to water rights holders
 14 (Oakdale ID and South San Joaquin ID) and CVP eastside contractors (Stockton
 15 East WD and Central San Joaquin WCD).

16 Water is provided to Oakdale ID and South San Joaquin ID in accordance with
 17 their 1988 Settlement Agreement with Reclamation (up to 600 TAF based on
 18 hydrologic conditions), limited by consumptive use. The conservation account of
 19 up to 200 TAF storage capacity defined under this agreement is not modeled in
 20 CalSim II.

21 *Water Supply-CVP Eastside Contractors*

22 Annual allocations are determined using New Melones water supply forecast (the
 23 end-of-February New Melones Storage, plus the March through September
 24 forecast of inflow to the reservoir) for Stockton East WD and Central San Joaquin
 25 WCD (Table 5A.B.14) and are distributed throughout 1 year using monthly
 26 patterns.

27 **Table 5A.B.14 CVP Contractor Allocations**

New Melones Water Supply Forecast (TAF)	CVP Contractor Allocation (TAF)
<1,400	10
1,400 to 1,800	59
>1,800	155

1 **5A.B3.1.2 DSM2 Assumptions for Alternative 3**

2 **5A.B3.1.2.1 Tidal Boundary**

3 Consistent with the Second Basis of Comparison and the No Action Alternative.

4 **5A.B3.1.2.2 Water Quality**

5 *Martinez EC*

6 Consistent with the Second Basis of Comparison and the No Action Alternative.

7 **5A.B3.1.2.3 Morphological Changes**

8 Consistent with the Second Basis of Comparison and the No Action Alternative.

9 **5A.B3.1.2.4 Facilities**

10 *South Delta Temporary Barriers*

11 Consistent with the Second Basis of Comparison and the No Action Alternative.

12 **5A.B3.1.2.5 Operations Criteria**

13 *South Delta Temporary Barriers*

14 Consistent with the No Action Alternative, South Delta Temporary Barriers are
15 operated based on San Joaquin flow conditions. Head of Old River Barrier is
16 assumed to be only installed from September 16 to November 30 and is not
17 installed in the spring months, based on the USFWS BO Action 5. The
18 agricultural barriers on Old and Middle Rivers are assumed to be installed starting
19 from May 16, and the one on Grant Line Canal from June 1. All three agricultural
20 barriers are allowed to operate until November 30. The tidal gates on Old and
21 Middle River agricultural barriers are assumed to be tied open from May 16 to
22 May 31.

23 *Montezuma Salinity Control Gate*

24 Consistent with the Second Basis of Comparison and the No Action Alternative.

25 **5A.B3.2 Alternative 5**

26 Alternative 5 model assumptions generally follow the No Action Alternative
27 simulation with the exception of more positive Old and Middle River Flows
28 requirement in April and May, and D 1641 pulse flows at Vernalis. Detailed
29 descriptions of Alternative 5 assumptions are described in Chapter 3, Description
30 of Alternatives.

31 Alternative 5 CalSim II and DSM2 assumptions that are different from the
32 No Action Alternative are described below.

33 **5A.B3.2.1 CalSim II Assumptions for Alternative 5**

34 **5A.B3.2.1.1 Demands, Water Rights, CVP and SWP Contracts**

35 Similar to the Second Basis of Comparison and the No Action Alternative.

1 **5A.B3.2.1.2 Facilities**

2 *Fremont Weir*

3 Consistent with the No Action Alternative and the Second Basis of Comparison.

4 *Banks Pumping Plant Capacity*

5 Consistent with the No Action Alternative and the Second Basis of Comparison.

6 *Jones Pumping Plant Capacity*

7 Consistent with the No Action Alternative and the Second Basis of Comparison.

8 **5A.B3.2.1.3 Regulatory Standards**

9 *Delta Outflow Index (Flow and Salinity)*

10 *SWRCB D-1641*

11 All flow-based Delta outflow requirements included in SWRCB D-1641 are
12 consistent with the No Action Alternative. Similarly, for the February through
13 June period, the X2 standard is included consistent with the No Action
14 Alternative.

15 *USFWS BO Action 4*

16 USFWS BO Action 4 requires additional Delta outflow to manage X2 in the fall
17 months following the Wet and Above Normal years. This action is included in
18 Alternative 5. The assumptions for this action under Alternative 5 are consistent
19 with the No Action Alternative.

20 *Combined Old and Middle River Flows*

21 The Alternative 5 OMR flow requirement is similar to the No Action Alternative
22 with the exception of positive OMR flows in April and May in all years.

23 *South Delta Export-San Joaquin River Inflow Ratio*

24 Consistent with the No Action Alternative.

25 *Exports at the South Delta Intakes*

26 Similar to the No Action Alternative, with the exception that the minimum health
27 and safety pumping of 1,500 cfs is not assumed for the months of April and May
28 under Alternative 5.

29 *Delta Water Quality*

30 Consistent with the No Action Alternative and the Second Basis of Comparison.

31 *San Joaquin River Restoration Program*

32 Consistent with the No Action Alternative simulation.

33 **5A.B3.2.1.4 Operations Criteria**

34 *Fremont Weir Operations*

35 Consistent with the No Action Alternative and the Second Basis of Comparison.

36 *Delta Cross Channel Gate Operations*

37 Consistent with the No Action Alternative and the Second Basis of Comparison.

1 *Allocation Decisions*

2 The rules and assumptions used for allocation decisions under Alternative 5 are
3 consistent with the No Action Alternative simulation.

4 *San Luis Operations*

5 The rules and assumptions used for San Luis Operations under Alternative 5 are
6 consistent with the No Action Alternative simulation.

7 *New Melones Operations*

8 New Melones operations assumed in Alternative 5 is similar to the No Action
9 Alternative with the exception of D-1641 Vernalis pulse flows.

10 *Fishery*

11 Similar to the No Action Alternative simulation, fishery flows refer to flow
12 requirements of the 2009 NMFS BO Action III.1.3 under Alternative 5.

13 *Water Quality*

14 Consistent with the No Action Alternative.

15 *Bay-Delta Flows*

16 Bay-Delta flow requirements are defined by D-1641 flow requirements at
17 Vernalis (not including pulse flows during the April 15 through May 16 period).
18 These flows are met through releases from New Melones without any annual
19 volumetric limit.

20 D-1641 requires flows at Vernalis to be maintained during the February through
21 June period and is based on the required location of X2 and the San Joaquin
22 Valley water year hydrologic classification (60-20-20 Index) as summarized in
23 Table 5A.B.15.

24 **Table 5A.B.15 Bay-Delta Vernalis Flow Objectives (average monthly cfs)**

60-20-20 Index	Flow Required if X2 is West of Chipps Island	Flow required if X2 is East of Chipps Island
Wet	3,420	2,130
Above Normal	3,420	2,130
Below Normal	2,280	1,420
Dry	2,280	1,420
Critical	1,140	710

25 In addition to the D-1641 “base” flows, D-1641 pulse flows for the April 15
26 through May 15 period are also simulated under Alternative 5 (Table 5A.B.16).

1 **Table 5A.B.16 Bay-Delta Vernalis Flow Objectives (average monthly cfs)**

60-20-20 Index	Pulse Flow Required if X2 is West of Chipps Island	Pulse Flow required if X2 is East of Chipps Island
Wet	8,620	7,330
Above Normal	7,020	5,730
Below Normal	5,480	4,620
Dry	4,880	4,020
Critical	3,540	3,110

2 *Water Supply*

3 Water supply refers to deliveries from New Melones to water rights holders
 4 (Oakdale ID and South San Joaquin ID) and CVP eastside contractors (Stockton
 5 East WD and Central San Joaquin WCD).

6 Water is provided to Oakdale ID and South San Joaquin ID in accordance with
 7 their 1988 Settlement Agreement with Reclamation (up to 600 TAF based on
 8 hydrologic conditions), limited by consumptive use. The conservation account of
 9 up to 200 TAF storage capacity defined under this agreement is not modeled in
 10 CalSim II.

11 *Water Supply-CVP Eastside Contractors*

12 Annual allocations are determined using New Melones water supply forecast (the
 13 end-of-February New Melones Storage, plus the March through September
 14 forecast of inflow to the reservoir) for Stockton East WD and Central San Joaquin
 15 WCD (Table 5A.B.17), and are distributed throughout 1 year using monthly
 16 patterns.

17 **Table 5A.B.17 CVP Contractor Allocations**

New Melones Water Supply Forecast (TAF)	CVP Contractor Allocation (TAF)
<1,400	0
1,400 to 1,800	49
>1,800	155

18 **5A.B3.2.2 DSM2 Assumptions for Alternative 5**

19 **5A.B3.2.2.1 Tidal Boundary**

20 Consistent with the No Action Alternative and the Second Basis of Comparison.

21 **5A.B3.2.2.2 Water Quality**

22 *Martinez EC*

23 Consistent with the No Action Alternative and the Second Basis of Comparison.

1 **5A.B3.2.2.3 Morphological Changes**

2 Consistent with the No Action Alternative and the Second Basis of Comparison.

3 **5A.B3.2.2.4 Facilities**

4 *South Delta Temporary Barriers*

5 Consistent with the No Action Alternative.

6 **5A.B3.2.2.5 Operations Criteria**

7 *South Delta Temporary Barriers*

8 Consistent with the No Action Alternative and the Second Basis of Comparison.

9 *Montezuma Salinity Control Gate*

10 Consistent with the No Action Alternative and the Second Basis of Comparison.

11 **5A.B3.3 Summary of Alternatives Assumptions**

12 A summary table of the EIS alternatives' assumptions is provided below for quick
13 reference (Table 5A.B.18).

14

1 **Table 5A.B.18 EIS Alternatives CalSim II Model Key Modeling Assumptions Summary**

		No Action Alternative and Alternative 2	Alternatives 1 and 4 and Second Basis of Comparison	Alternative 3	Alternative 5
USFWS BO RPAs	Action 1 – First Flush	Represented	Not Represented	Modified to be operationally less restrictive (-7,500 cfs limit)	Represented
	Action 2 – Adult Protection OMR	Represented	Not Represented	Modified to be operationally less restrictive (-7,500 cfs limit)	Represented
	Action 3 – Juvenile Protection OMR	Represented	Not Represented	Modified to be operationally less restrictive (-7,500 cfs limit)	Modified to be operationally more restrictive
	Action 4 – Fall X2	Represented	Not Represented	Not Represented	Represented
	Action 5 – Spring HORB	Represented	Not Represented	Represented	Represented
NMFS BO RPAs	I.1.1 – Clear Creek Spring Attraction	Represented	Not Represented	Not Represented	Represented
	I.3.1, I.3.2, I.3.3 – Red Bluff Ops	Represented	Represented	Represented	Represented
	I.7 – Yolo Bypass Modification	Represented using BDCP Modeling Logic	Represented using BDCP Modeling Logic	Represented using BDCP Modeling Logic	Represented using BDCP Modeling Logic
	III.1.3 – Goodwin Flow Schedule	Represented per Appendix 2E Table	Fishery Flows from 1997 IPO	Fishery Flows from OID/SSJID Plan (2012)	Represented per Appendix 2E Table

Appendix 5A: CalSim II and DSM2 Modeling Simulations and Assumptions

		No Action Alternative and Alternative 2	Alternatives 1 and 4 and Second Basis of Comparison	Alternative 3	Alternative 5
NMFS BO RPAs	IV.1.2 – DCC Ops	Represented per RPA	Represented per D-1641	Represented per D-1641	Represented per RPA
	IV.2.1 – I/E Ratio	Represented	Not Represented	Not Represented	Represented
	IV.2.3 – OMR	See USFWS Actions 1-3	See USFWS Actions 1-3	See USFWS Actions 1-3	See USFWS Actions 1-3
Spring Delta Outflow		D-1641	D-1641	D-1641	Increased from D-1641 due to OMR Action in April and May
Releases from Goodwin	Fishery Flows	NMFS RPA III.1.3 (Appendix 2E)	Fishery Flows from 1997 Interim Plan of Operations	Fishery Flows from OID/SSJID Proposal (2012)	NMFS RPA III.1.3 (Appendix 2E)
	Vernalis Base Flow	D-1641 – no cap	D-1641 – no cap	N/A	D-1641 – no cap
	Vernalis Pulse Flow	N/A	N/A	N/A	D-1641 – no cap
	Vernalis Salinity	D-1641—no cap	D-1641—no cap	N/A	D-1641 – no cap
	Dissolved Oxygen	D-1641 standard at Ripon	D-1641 standard at Ripon	D-1641 standard at Orange Blossom Bridge (no model changes)	D-1641 standard at Ripon
OID/SSJID Deliveries		1988 Agreement limited by consumptive use, no conservation account	1988 Agreement limited by consumptive use, no conservation account	1988 Agreement limited by consumptive use, no conservation account	1988 Agreement limited by consumptive use, no conservation account
CVP Contractor Allocations		Based on New Melones Index: <1,400 = 0 TAF 1,400-1,800 = 49 TAF >1,800 = 155 TAF	Based on New Melones Index: <1,400 = 0 TAF 1,400-1,800 = 49 TAF >1,800 = 155 TAF	Based on New Melones Index: <1,400 = 0 TAF 1,400-1,800 = 59 TAF >1,800 = 155 TAF	Based on New Melones Index: <1,400 = 0 TAF 1,400-1,800 = 49 TAF >1,800 = 155 TAF

1 **5A.B4 Timeframe of Evaluation**

2 The No Action Alternative, the Second Basis of Comparison, and the other
 3 alternatives are simulated at Year 2030 conditions. Changes in climate conditions
 4 and sea level (15-cm rise) were assumed at Year 2030 and are consistent within
 5 all alternatives.

6 Using this approach, the climate scenario was derived based on sampling of the
 7 ensemble of global climate model projections rather than one single realization or
 8 a handful of individual realizations. The Q5 scenario that represents the central
 9 tendency of the climate projections was selected for the EIS analysis.

10 Simulation of climate change and sea-level rise effects in CalSim II modeling of
 11 the alternatives is accomplished by:

- 12 • Incorporating the modified CalSim II inputs reflecting climate change for
 13 parameters including, inflows, water year types, runoff forecasts, and Delta
 14 water temperature.
- 15 • Incorporating modified ANNs to reflect the flow-salinity response under sea
 16 level change.

17 Simulation of the tidal marsh restoration areas and sea-level rise effects in DSM2
 18 modeling of the alternatives is accomplished by:

- 19 • Incorporating consistent grid changes identified in corroboration simulation
 20 into the DSM2 model for the sea-level rise condition.
- 21 • Modifying the downstream stage and EC boundary conditions at Martinez in
 22 the DSM2 model using the appropriate regression equation for the 15-cm sea-
 23 level rise. The adjusted astronomical tide specified at Martinez in the
 24 alternatives is modified using the correlations shown in Table 5A.B.19. The
 25 Martinez EC boundary condition resulting from the G-model is modified
 26 using the correlations specified in the Table 5A.B.19.

27 **Table 5A.B.19 Correlation to Transform Baseline Martinez Stage and EC for use in**
 28 **Alternatives DSM2 Simulations at Year 2030**

Scenario	Martinez Stage (feet NGVD 29)		Martinez EC (µS/cm)	
	Correlation	Lag (min)	Correlation	Lag (min)
Year 2030 (15cm SLR)	$Y = 1.0033 * X + .47$	-1	$Y = 0.9954 * X + 556.3$	0

29 Notes:

30 X = Baseline Martinez stage or EC

31 Y = Alternative Martinez stage or EC

1 **5A.B5 No Action Alternative and Second Basis of**
2 **Comparison Callout Tables**

3 **5A.B5.1 CalSim II Assumptions**

4 This subsection provides a summary of the CalSim II assumptions for the
5 No Action Alternative and the Second Basis of Comparison (Table 5A.B.20).

6 **5A.B5.2 DSM2 Assumptions**

7 This subsection provides a summary of the DSM2 assumptions for the No Action
8 Alternative and the Second Basis of Comparison (Table 5A.B.21).

9 **5A.B6 American River Demands**

10 This section includes the information in the “Bay Delta Conservation Plan
11 EIR/EIS Project—CalSim II Baselines Models—American River Assumptions,”
12 dated February 17, 2010.

13 **5A.B6.1 Introduction**

14 The following is a summary of the assumptions that are EIS alternatives. For
15 specific diversion-related assumptions, see the following section.

- 16 • American River Flow Management is included, as required by the June 2009
17 NMFS Biological Opinion Action II.1.
- 18 • Water rights and CVP demands are assumed at a full buildout condition with
19 CVP contracts at full contract amounts
- 20 • Placer County Water Agency (PCWA) Pump Station is included at full
21 demand
- 22 • Freeport Regional Water Project (FRWP) is included at full demand (East Bay
23 Municipal Utility District (EBMUD) CVP contracts and SCWA CVP contract
24 and new appropriative water rights and water acquisitions as modeled in the
25 FRWP EIS/R)
 - 26 – Sacramento River Water Reliability Project is not included
 - 27 – Sacramento Area Water Forum is not included (dry year “wedge”
28 reductions and mitigation water releases are not included)

29 **5A.B6.2 Summary of Demands**

30 The Table 5A.B.22 below summarizes the water rights, CVP contract amounts,
31 and demand amounts for each diverter in the American River system in the
32 No Action Alternative and the Second Basis of Comparison.

33

1 **Table 5A.B.20 CalSim II Inputs – Assumptions**

	No Action Alternative Assumption	Second Basis of Comparison Assumption
Planning horizon ^a	Year 2030	Same
Demarcation date ^a	March 2012	Same
Period of simulation	82 years (1922-2003)	Same
HYDROLOGY		
Inflows/Supplies	Historical with modifications for operations upstream of rim reservoirs and with changed climate at Year 2030	Same
Level of development	Projected 2030 level ^c	Same
DEMANDS, WATER RIGHTS, CVP and SWP CONTRACTS		
Sacramento River Region (excluding American River)		
CVP ^d	Land-use based, full buildout of contract amounts	Same
SWP (FRSA) ^e	Land-use based, limited by contract amounts	Same
Non-project	Land-use based, limited by water rights and SWRCB Decisions for Existing Facilities	Same
Antioch Water Works	Pre-1914 water right	Same
Federal refuges ^f	Firm Level 2 water needs	Same
Sacramento River Region—American River^g		
Water rights	Year 2025, full water rights	Same
CVP	Year 2025, full contracts, including Freeport Regional Water Project	Same
San Joaquin River Region^h		
Friant Unit	Limited by contract amounts, based on current allocation policy	Same
Lower Basin	Land-use based, based on district level operations and constraints	Same

Appendix 5A: CalSim II and DSM2 Modeling Simulations and Assumptions

	No Action Alternative Assumption	Second Basis of Comparison Assumption
Stanislaus River ⁱ	Land-use based, Revised Operations Plan ^t and NMFS BO (June 2009) Actions III.1.2 and III.1.3 ^v	Land-use based, Revised Operations Plan ^t
San Francisco Bay, Central Coast, Tulare Lake and South Coast Regions (CVP and SWP project facilities)		
CVP ^d	Demand based on contract amounts	Same
CCWD ^l	195 TAF/year CVP contract supply and water rights	Same
SWP ^{e,k}	Demand based on Table A amounts	Same
Article 56	Based on 2001-2008 contractor requests	Same
Article 21	MWD demand up to 200 TAF/month from December to March subject to conveyance capacity, Kern County Water Agency demand up to 180 TAF/month, and other contractor demands up to 34 TAF/month in all months, subject to conveyance capacity	Same
North Bay Aqueduct (NBA)	77 TAF/yr demand under SWP contracts, up to 43.7 cfs of excess flow under Fairfield, Vacaville, and Benicia Settlement Agreement	Same
Federal refuges ^f	Firm Level 2 water needs	Same
FACILITIES		
Systemwide	Existing facilities	Same
Sacramento River Region		
Shasta Lake	Existing, 4,552 TAF capacity	Same
Red Bluff Diversion Dam	Diversion dam operated with gates out all year, NMFS BO (June 2009) Action I.3.1 ^v ; assume permanent facilities in place	Same
Colusa Basin	Existing conveyance and storage facilities	Same
Upper American River ^{g,l}	PCWA American River Pump Station	Same
Lower Sacramento River	Freeport Regional Water Project ⁿ	Same
San Joaquin River Region		
Millerton Lake (Friant Dam)	Existing, 520 TAF capacity	Same

Appendix 5A: CalSim II and DSM2 Modeling Simulations and Assumptions

	No Action Alternative Assumption	Second Basis of Comparison Assumption
Lower San Joaquin River	City of Stockton Delta Water Supply Project, 30-mgd capacity	Same
Delta Region		
SWP Banks Pumping Plant (South Delta)	Physical capacity is 10,300 cfs but 6,680 cfs permitted capacity in all months up to 8,500 cfs during Dec. 15 through Mar. 15 depending on Vernalis flow conditions ^o ; additional capacity of 500 cfs (up to 7,180 cfs) allowed for July through Sept. for reducing impact of NMFS BO (June 2009) Action IV.2.1 Phase II ^v on SWP ^w	Physical capacity is 10,300 cfs but 6,680 cfs permitted capacity in all months up to 8,500 cfs during Dec. 15 through Mar. 15 depending on Vernalis flow conditions ^o ; additional capacity of 500 cfs (up to 7,180 cfs) allowed for July through Sept. for reducing impact of B2 Actions.
CVP C.W. Bill Jones Pumping Plant (Tracy Pumping Plant)	Permit capacity is 4,600 cfs in all months (allowed for by the Delta-Mendota Canal-California Aqueduct Intertie)	Same
Upper Delta-Mendota Canal Capacity	Existing plus 400 cfs Delta-Mendota Canal-California Aqueduct Intertie	Same
CCWD Intakes	Los Vaqueros existing storage capacity, 160 TAF, existing pump locations, AIP included ^p	Same
San Francisco Bay Region		
South Bay Aqueduct (SBA)	SBA rehabilitation, 430 cfs capacity from junction with California Aqueduct to Zone 7 Water Agency diversion point	Same
South Coast Region		
California Aqueduct East Branch	Existing capacity	Same
REGULATORY STANDARDS		
North Coast Region		
<i>Trinity River</i>		
Minimum flow below Lewiston Dam	Trinity EIS Preferred Alternative (369-815 TAF/year)	Same

Appendix 5A: CalSim II and DSM2 Modeling Simulations and Assumptions

	No Action Alternative Assumption	Second Basis of Comparison Assumption
Trinity Reservoir end-of-September minimum storage	Trinity EIS Preferred Alternative (600 TAF as able)	Same
Sacramento River Region		
<i>Clear Creek</i>		
Minimum flow below Whiskeytown Dam	Downstream water rights, 1963 Reclamation Proposal to USFWS and NPS, predetermined CVPIA 3406(b)(2) flows ^q , and NMFS BO (June 2009) Action I.1.1 ^v	Downstream water rights, 1963 Reclamation Proposal to USFWS and NPS, predetermined CVPIA 3406(b)(2) flows ^q
<i>Upper Sacramento River</i>		
Shasta Lake end-of-September minimum storage	NMFS 2004 Winter-run Biological Opinion, (1900 TAF in non-critically dry years), and NMFS BO (June 2009) Action I.2.1 ^v	NMFS 2004 Winter-run Biological Opinion, (1900 TAF in non-critically dry years)
Minimum flow below Keswick Dam	SWRCB WR 90-5, predetermined CVPIA 3406(b)(2) flows ^q , and NMFS BO (June 2009) Action I.2.2 ^v	SWRCB WR 90-5, predetermined CVPIA 3406(b)(2) flows ^q
<i>Feather River</i>		
Minimum flow below Thermalito Diversion Dam	2006 Settlement Agreement (700/800 cfs)	Same
Minimum flow below Thermalito Afterbay outlet	1983 DWR, DFW Agreement (750-1,700 cfs)	Same
<i>Yuba River</i>		
Minimum flow below Daguerre Point Dam	D-1644 Operations (Lower Yuba River Accord) ^f	Same
<i>American River</i>		
Minimum flow below Nimbus Dam	American River Flow Management ^g as required by NMFS BO (June 2009) Action II.1 ^v	Same
Minimum Flow at H Street Bridge	SWRCB D-893	Same

Appendix 5A: CalSim II and DSM2 Modeling Simulations and Assumptions

	No Action Alternative Assumption	Second Basis of Comparison Assumption
<i>Lower Sacramento River</i>		
Minimum flow near Rio Vista	SWRCB D-1641	Same
San Joaquin River Region		
<i>Mokelumne River</i>		
Minimum flow below Camanche Dam	FERC 2916-029, 1996 (Joint Settlement Agreement) (100-325 cfs)	Same
Minimum flow below Woodbridge Diversion Dam	FERC 2916-029, 1996 (Joint Settlement Agreement) (25-300 cfs)	Same
<i>Stanislaus River</i>		
Minimum flow below Goodwin Dam	1987 Reclamation, DFW agreement, and flows required for NMFS BO (June 2009) Action III.1.2 and III.1.3 ^v	1987 Reclamation, DFW agreement
Minimum dissolved oxygen	SWRCB D-1422	Same
<i>Merced River</i>		
Minimum flow below Crocker-Huffman Diversion Dam	Davis-Grunsky (180-220 cfs, Nov.-Mar.), and Cowell Agreement	Same
Minimum flow at Shaffer Bridge	FERC 2179 (25-100 cfs)	Same
<i>Tuolumne River</i>		
Minimum flow at Lagrange Bridge	FERC 2299-024, 1995 (Settlement Agreement) (94-301 TAF/yr)	Same
<i>San Joaquin River</i>		
San Joaquin River below Friant Dam/ Mendota Pool	San Joaquin River Restoration-full flows, not constrained by current canal capacity ^u	Same
Maximum salinity near Vernalis	SWRCB D-1641	Same
Minimum flow near Vernalis	SWRCB D-1641, and NMFS BO (June 2009) Action IV.2.1 ^v	SWRCB D-1641

Appendix 5A: CalSim II and DSM2 Modeling Simulations and Assumptions

	No Action Alternative Assumption	Second Basis of Comparison Assumption
<i>Sacramento River – San Joaquin Delta Region</i>		
Delta Outflow Index (Flow and Salinity)	SWRCB D-1641 and USFWS BO (Dec. 2008) Action 4	SWRCB D-1641
Delta Cross Channel gate operation	SRWCB D-1641 with additional days closed from Oct. 1 – Jan. 31 based on NMFS BO (June 2009) Action IV.1.2 ^v (closed during flushing flows from Oct. 1 – Dec. 14 unless adverse water quality conditions)	SRWCB D-1641
South Delta exports (Jones Pumping Plant and Banks Pumping Plant)	SWRCB D-1641, Vernalis flow-based export limits Apr. 1 – May 31 as required by NMFS BO (June 2009) Action IV.2.1 ^v (additional 500 cfs allowed for July – Sept. For reducing impact on SWP) ^w	SWRCB D-1641 (additional 500 cfs allowed for July – Sept. For reducing impact of B2 Actions)
Combined Flow in OMR	USFWS BO (Dec. 2008) Actions 1 through 3 and NMFS BO (June 2009) Action IV.2.3 ^v	None
OPERATIONS CRITERIA: RIVER-SPECIFIC		
Sacramento River Region		
<i>Upper Sacramento River</i>		
Flow objective for navigation (Wilkins Slough)	NMFS BO (June 2009) Action I.4 ^v ; 3,500 – 5,000 cfs based on CVP water supply condition	Same
<i>American River</i>		
Folsom Dam flood control	Variable 400/670 flood control diagram (without outlet modifications)	Same
<i>Feather River</i>		
Flow at Mouth of Feather River (above Verona)	Maintain DFW/DWR flow target of 2,800 cfs for Apr. through Sept. dependent on Oroville inflow and FRSA allocation	Same
San Joaquin River Region		
<i>Stanislaus River</i>		
Flow below Goodwin Dam ⁱ	Revised Operations Plan ^t and NMFS BO (June 2009) Action III.1.2 and III.1.3 ^v	Revised Operations Plan ^t

Appendix 5A: CalSim II and DSM2 Modeling Simulations and Assumptions

	No Action Alternative Assumption	Second Basis of Comparison Assumption
<i>San Joaquin River</i>		
Salinity at Vernalis	Grasslands Bypass Project (full implementation)	Same
OPERATIONS CRITERIA: SYSTEMWIDE		
<i>CVP water allocation</i>		
Settlement/Exchange	100 percent (75 percent in Shasta critical years)	Same
Refuges	100 percent (75 percent in Shasta critical years)	Same
Agriculture Service	100 percent-0 percent based on supply, South-of-Delta allocations are additionally limited due to D-1641, USFWS BO (Dec. 2008) and NMFS BO (June 2009) export restrictions ^v	100 percent-0 percent based on supply, South-of-Delta allocations are additionally limited due to D-1641
Municipal & Industrial Service	100 percent-50 percent based on supply, South-of-Delta allocations are additionally limited due to D-1641, USFWS BO (Dec. 2008) and NMFS BO (June 2009) export restrictions ^v	100 percent-50 percent based on supply, South-of-Delta allocations are additionally limited due to D-1641
<i>SWP water allocation</i>		
North of Delta (FRSA)	Contract specific	Same
South of Delta (including North Bay Aqueduct)	Based on supply; equal prioritization between Ag and M&I based on Monterey Agreement; allocations are additionally limited due to D-1641 and USFWS BO (Dec. 2008) and NMFS BO (June 2009) export restrictions ^v	Based on supply; equal prioritization between Ag and M&I based on Monterey Agreement; allocations are additionally limited due to D-1641
<i>CVP-SWP coordinated operations</i>		
Sharing of responsibility for in-basin-use	1986 Coordinated Operations Agreement (FRWP EBMUD and 2/3 of the North Bay Aqueduct diversions considered as Delta Export; 1/3 of the North Bay Aqueduct diversion as in-basin-use)	Same
Sharing of surplus flows	1986 Coordinated Operations Agreement	Same

Appendix 5A: CalSim II and DSM2 Modeling Simulations and Assumptions

	No Action Alternative Assumption	Second Basis of Comparison Assumption
Sharing of total allowable export capacity for project-specific priority pumping	Equal sharing of export capacity under SWRCB D-1641, USFWS BO (Dec. 2008) and NMFS BO (June 2009) export restrictions ^v	Equal sharing of export capacity under SWRCB D-1641
Water transfers	Acquisitions by SWP contractors are wheeled at priority in Banks Pumping Plant over non-SWP users; LYRA included for SWP contractors ^w	Same
Sharing of total allowable export capacity for lesser priority and wheeling-related pumping	Cross Valley Canal wheeling (max of 128 TAF/year), CALFED ROD defined Joint Point of Diversion (JPOD)	Same
San Luis Reservoir	San Luis Reservoir is allowed to operate to a minimum storage of 100 TAF	Same
<i>CVPIA 3406(b)(2)^{v,q}</i>		
Policy Decision	Per May 2003 Department Decision:	Same
Allocation	800 TAF, 700 TAF in 40-30-30 dry years, and 600 TAF in 40-30-30 critical years as a function of Ag allocation	Same
Actions	Predetermined upstream fish flow objectives below Whiskeytown and Keswick Dams, non-discretionary NMFS BO (June 2009) actions for the American and Stanislaus Rivers, and NMFS BO (June 2009) and USFWS BO (Dec. 2008) actions leading to export restrictions ^v	Predetermined upstream fish flow objectives below Whiskeytown and Keswick Dams
Accounting	Releases for non-discretionary USFWS BO (Dec. 2008) and NMFS BO (June 2009) ^v actions may or may not always be deemed (b)(2) actions; in general, it is anticipated that, accounting of these actions using (b)(2) metrics, the sum would exceed the (b)(2) allocation in many years; therefore no additional actions are considered and no accounting logic is included in the model ^q	No accounting logic is included in the model

	No Action Alternative Assumption	Second Basis of Comparison Assumption
WATER MANAGEMENT ACTIONS		
<i>Water Transfer Supplies (long-term programs)</i>		
Lower Yuba River Accord ^w	Yuba River acquisitions for reducing impact of NMFS BO export restrictions ^v on SWP	Yuba River acquisitions
Phase 8	None	None
Water Transfers (short-term or temporary programs)		
Sacramento Valley acquisitions conveyed through Banks Pumping Plant ^x	Post-analysis of available capacity	Post-analysis of available capacity

Notes:

- 1
- 2 a. These assumptions were developed under the direction of the DWR and Reclamation in 2010. Only operational components
- 3 of 2008 USFWS and 2009 NMFS BOs as of demarcation date of No Action Alternative and the No action Alternative
- 4 assumptions are included. Restoration of at least 8,000 acres of intertidal and associated subtidal habitat in the Delta and
- 5 Suisun Marsh required by the 2008 USFWS BO and restoration of at least 17,000 to 20,000 acres of floodplain rearing habitat
- 6 for juvenile winter-run and spring-run Chinook Salmon and Central Valley Steelhead in the Yolo Bypass and/or suitable areas
- 7 of the lower Sacramento River required by the NMFS 2009 BO are not included in the No Action Alternative assumptions
- 8 because environmental documents of projects regarding these actions were not completed as of the publication date of the
- 9 Notice of Preparation/Notice of Intent (February 13, 2009).
- 10 b. The Sacramento Valley hydrology used in the No Action Alternative CalSim II model reflects nominal 2005 land-use
- 11 assumptions. The nominal 2005 land use was determined by interpolation between the 1995 and projected 2020 land-use
- 12 assumptions associated with Bulletin 160-98. The San Joaquin Valley hydrology reflects 2005 land-use assumptions
- 13 developed by Reclamation. Existing-level projected land-use assumptions are being coordinated with the California Water
- 14 Plan Update for future models.
- 15 c. The Sacramento Valley hydrology used in the No Action Alternative CalSim II model reflects 2020 land-use assumptions
- 16 associated with Bulletin 160-98. The San Joaquin Valley hydrology reflects draft 2030 land-use assumptions developed by
- 17 Reclamation. Development of Future-level projected land-use assumptions are being coordinated with the California Water
- 18 Plan Update for future models.
- 19 d. CVP contract amounts have been updated according to existing and amended contracts as appropriate. Assumptions
- 20 regarding CVP agricultural and M&I service contracts and Settlement Contract amounts are documented in the
- 21 Delivery Specifications attachments.
- 22 e. SWP contract amounts have been updated as appropriate based on recent Table A transfers/agreements. Assumptions
- 23 regarding SWP agricultural and M&I contract amounts are documented in the Delivery Specifications attachments.

Appendix 5A: CalSim II and DSM2 Modeling Simulations and Assumptions

- 1 f. Water needs for Federal refuges have been reviewed and updated as appropriate. Assumptions regarding firm Level 2 refuge
2 water needs are documented in the Delivery Specifications attachments. Refuge Level 4 (and incremental Level 4) water is
3 not analyzed.
- 4 g. Assumptions regarding American River water rights and CVP contracts are documented in the Delivery Specifications
5 attachments. The Sacramento Area Water Forum agreement, its dry year diversion reductions, Middle Fork Project operations
6 and “mitigation” water is not included.
- 7 h. The new CalSim II representation of the San Joaquin River has been included in this model package (CalSim II San Joaquin
8 River Model, Reclamation, 2005). Updates to the San Joaquin River have been included since the preliminary model release
9 in August 2005. The model reflects the difficulties of ongoing groundwater overdraft problems. The 2030 level of development
10 representation of the San Joaquin River Basin does not make any attempt to offer solutions to groundwater overdraft problems.
11 In addition a dynamic groundwater simulation is not yet developed for the San Joaquin River Valley. Groundwater
12 extraction/recharge and stream-groundwater interaction are static assumptions and may not accurately reflect a response to
13 simulated actions. These limitations should be considered in the analysis of results.
- 14 i. The CalSim II model representation for the Stanislaus River does not necessarily represent Reclamation’s current or future
15 operational policies. A suitable plan for supporting flows has not been developed for NMFS BO (June 2009) Action 3.1.3.
- 16 j. The actual amount diverted is operated in conjunction with supplies from the Los Vaqueros project. The existing Los Vaqueros
17 storage capacity is 160 TAF. Associated water rights for Delta excess flows are included.
- 18 k. Under No Action Alternative, it is assumed that SWP Contractors demand for Table A allocations vary from 3.0 to 4.1 million
19 acre-feet (MAF)/year. Under the No Action Alternative, it is assumed that SWP Contractors can take delivery of all Table A
20 allocations and Article 21 supplies. Article 56 provisions are assumed and allow for SWP Contractors to manage storage and
21 delivery conditions such that full Table A allocations can be delivered. Article 21 deliveries are limited in Wet years under the
22 assumption that demand is decreased in these conditions. Article 21 deliveries for the NBA are dependent on excess
23 conditions only, all other Article 21 deliveries also require that San Luis Reservoir be at capacity and that Banks Pumping Plant
24 and the California Aqueduct have available capacity to divert from the Delta for direct delivery.
- 25 l. PCWA American River pumping facility upstream of Folsom Lake is included in both the Existing and No Action Alternative No
26 Action Alternative. The diversion is assumed to be 35.5 TAF/Yr.
- 27 m. footnote removed
- 28 n. footnote removed
- 29 o. Current USACE permit for Banks Pumping Plant allows for an average diversion rate of 6,680 cfs in all months. Diversion rate
30 can increase up to 1/3 of the rate of San Joaquin River flow at Vernalis from Dec. 15th to Mar. 15th, up to a maximum
31 diversion of 8,500 cfs, if Vernalis flow exceeds 1,000 cfs.
- 32 p. The CCWD AIP is an intake at Victoria Canal that operates as an alternate Delta diversion for Los Vaqueros Reservoir. This
33 assumption is consistent with the future no-project condition defined by the Los Vaqueros Enlargement study team.
- 34 q. CVPIA (b)(2) fish actions are not dynamically determined in the CalSim II model, nor is (b)(2) accounting done in the model.
35 Since the USFWS BO and NMFS BO were issued, the Department has exercised its discretion to use (b)(2) in the delta by
36 accounting some or all of the export reductions required under those biological opinions as (b)(2) actions. It is therefore
37 assumed for modeling purposes that (b)(2) availability for other delta actions will be limited to covering the CVP’s VAMP export

- 1 reductions. Similarly, since the USFWS BO and NMFS BO were issued, the Department has exercised its discretion to use
2 (b)(2) upstream by accounting some or all of the release augmentations (relative to the hypothetical (b)(2) base case) below
3 Whiskeytown, Nimbus, and Goodwin as (b)(2) actions. It is therefore assumed for modeling purposes that (b)(2) availability for
4 other upstream actions will be limited to covering Sacramento releases, in the fall and winter. For modeling purposes,
5 predetermined time series of minimum instream flow requirements are specified. The time series are based on the Aug. 2008
6 BA Study 7.0 and Study 8.0 simulations which did include dynamically determined (b)(2) actions.
- 7 r. D-1644 and the Lower Yuba River Accord is assumed to be implemented for Existing and No Action Alternative No Action
8 Alternative. The Yuba River is not dynamically modeled in CalSim II. Yuba River hydrology and availability of water
9 acquisitions under the Lower Yuba River Accord are based on modeling performed and provided by the Lower Yuba River
10 Accord EIS/EIR study team.
- 11 s. Under Existing Conditions, the flow components of the proposed American River Flow Management are as required by the
12 NMFS BO (June 4, 2009).
- 13 t. The model operates the Stanislaus River using a 1997 Interim Plan of Operation-like structure, i.e., allocating water for
14 Stockton East Water District and CSJWCD, Vernalis water quality dilution, and Vernalis D-1641 flow requirements based on
15 the New Melones Index. Oakdale Irrigation District and South San Joaquin Irrigation District allocations are based on their
16 1988 agreement and Ripon DO requirements are represented by a static set of minimum instream flow requirements during
17 June thru Sept. Instream flow requirements for fish below Goodwin are based on NMFS BO Action III.1.2. NMFS BO Action
18 IV.2.1's flow component is not assumed to be in effect.
- 19 u. SJR Restoration Water Year 2010 Interim Flows Project are assumed, but are *not input into the models; operation not regularly*
20 *defined at this time*
- 21 v. In cooperation with Reclamation, National Marine Fisheries Service, U.S. Fish and Wildlife Service, and California Department
22 of Fish and Wildlife, the Department of Water Resources has developed assumptions for implementation of the USFWS BO
23 (Dec. 15, 2008) and NMFS BO (June 4, 2009) in CalSim II.
- 24 w. Acquisitions of Component 1 water under the Lower Yuba River Accord, and use of 500 cfs dedicated capacity at Banks
25 Pumping Plant during July through Sept., are assumed to be used to reduce as much of the impact of the April through May
26 Delta export actions on SWP contractors as possible.
- 27 x. Only acquisitions of Lower Yuba River Accord Component 1 water are included.

1 **Table 5A.B.21 DSM2 Assumptions**

	No Action Alternative Assumption	Second Basis of Comparison Assumption
Period of simulation	82 years (1922-2003) ^{a,b}	Same
REGIONAL SUPPLIES		
Boundary flows	Monthly time series from CalSim II output (alternatives provide different flows and exports) ^c	Same
REGIONAL DEMANDS AND CONTRACTS		
Ag flows (DICU)	2005 Level, DWR Bulletin 160-98 ^d	2020 Level, DWR Bulletin 160-98 ^d
TIDAL BOUNDARY		
Martinez stage	15-minute adjusted astronomical tide ^a	Same
WATER QUALITY		
Vernalis EC	Monthly time series from CalSim II output ^e	Monthly time series from CalSim II output ^e
Agricultural Return EC	Municipal Water Quality Investigation Program analysis	Same
Martinez EC	Monthly net Delta Outflow from CalSim II output and G-model ^f	Monthly net Delta Outflow from CalSim II output and G-model ^f
MORPHOLOGICAL CHANGES		
Mokelumne River	None	None
San Joaquin River	None	None
Middle River	None	None
Dutch Slough Restoration Project	None	None

	No Action Alternative Assumption	Second Basis of Comparison Assumption
FACILITIES		
Contra Costa Water District Delta Intakes	Rock Slough Pumping Plant, Old River at Highway 4 Intake	Rock Slough Pumping Plant, Old River at Highway 4 Intake and Alternate Improvement Project Intake on Victoria Canal
South Delta barriers	Temporary Barriers Program	Same
Two Gate Program	None	None
Franks Tract Program	None	None
SPECIFIC PROJECTS		
Water Supply Intake Projects		
Freeport Regional Water Project	None	Monthly output from CalSim II
Stockton Delta Water Supply Project	None	Monthly output from CalSim II
Antioch Water Works	Monthly output from CalSim II	Monthly output from CalSim II
Sanitary and Agricultural Discharge Projects		
Veale Tract Drainage Relocation	The Veale Tract Water Quality Improvement Project, funded by CALFED, relocates the agricultural drainage outlet that was relocated from Rock Slough channel to the southern end of Veale Tract, on Indian Slough ^k	Same
OPERATIONS CRITERIA		
Delta Cross Channel	Monthly time series of number of days open from CalSim II output	Monthly time series of number of days open from CalSim II output
Clifton Court Forebay	Priority 3, gate operations synchronized with incoming tide to minimize impacts to low water levels in nearby channels	Same

Appendix 5A: CalSim II and DSM2 Modeling Simulations and Assumptions

	No Action Alternative Assumption	Second Basis of Comparison Assumption
South Delta barriers	Temporary Barriers Project operated based on San Joaquin River flow time series from CalSim II output; HORB is assumed only installed ^l Sept. 16 through Nov. 30; agricultural barriers on OMR are assumed to be installed starting from May 16 and on Grant Line Canal from June 1; all three barriers are allowed to be operated until November 30; May 16 to May 31; the tidal gates are assumed to be tied open for the barriers on Old and Middle Rivers ^m .	Temporary Barriers Project operated based on San Joaquin River flow time series from CalSim II output; HORB is assumed installed ^l April 1 through May 31 and Sept. 16 through Nov. 30; agricultural barriers on OMR are assumed to be installed starting from May 16 and on Grant Line Canal from June 1; all three barriers are allowed to be operated until November 30; May 16 to May 31; the tidal gates are assumed to be tied open for the barriers on ORM ^m

- 1 Notes:
- 2 a. A new adjusted astronomical tide for use in DSM2 planning studies has been developed by DWR's Bay Delta Office Modeling
- 3 Support Branch Delta Modeling Section in cooperation with the Common Assumptions workgroup. This tide is based on a
- 4 more extensive observed dataset and covers the entire 82-year period of record.
- 5 b. The 16-year period of record is the simulation period for which DSM2 has been commonly used for impacts analysis in many
- 6 previous projects, and includes varied water year types.
- 7 c. Although monthly CalSim II output was used as the DSM2-HYDRO input, the Sacramento and San Joaquin rivers were
- 8 interpolated to daily values in order to smooth the transition from high to low and low to high flows. DSM2 then uses the daily
- 9 flow values along with a 15-minute adjusted astronomical tide to simulate effect of the spring and neap tides.
- 10 d. The Delta Island Consumptive Use (DICU) model is used to calculate diversions and return flows for all Delta islands based on
- 11 the level of development assumed. The nominal 2005 Delta region hydrology land use was determined by interpolation
- 12 between the 1995 and projected 2020 land-use assumptions associated with Bulletin 160-98.
- 13 e. CalSim II calculates monthly EC for the San Joaquin River, which was then converted to daily EC using the monthly EC and
- 14 flow for the San Joaquin River. Fixed concentrations of 150, 175, and 125 µmhos/cm were assumed for the Sacramento River,
- 15 Yolo Bypass, and eastside streams, respectively.
- 16 f. Net Delta outflow based on the CalSim II flows was used with an updated G-model to calculate Martinez EC. Under changed
- 17 climate conditions, Martinez EC is modified to account for the sea-level rise at early (15 cm) and late (45 cm) long-term phases
- 18 (Year 2060).
- 19 g. footnote removed.
- 20 h. footnote removed.
- 21 i. footnote removed.
- 22 j. footnote removed.

- 1 k. Information was obtained based on the information from the draft final “Delta Region Drinking Water Quality Management Plan”
- 2 dated June 2005 prepared under the CALFED Water Quality Program and a presentation by David Briggs at SWRCB public
- 3 workshop for periodic review. The presentation “Compliance Location at Contra Costa Canal at Pumping Plant #1 –
- 4 Addressing Local Degradation” notes that the Veale Tract drainage relocation project will be operational in June 2005. The
- 5 DICU drainage currently simulated at node 204 is moved to node 202 in DSM2.
- 6 l. Based on the USFWS BO Action 5, HORB is assumed to be not installed in April or May; therefore HORB is only installed in
- 7 the fall, as shown.
- 8 m. Based on the USFWS BO Action 5 and the project description provided in the page 119.

9 **Table 5A.B.22 American River Diversions Assumed in the No Action Alternative and Second Basis of Comparison**

	Diversion Location	No Action Alternative and Second Basis of Comparison (TAF/yr)	No Action Alternative and Second Basis of Comparison (TAF/yr)	No Action Alternative and Second Basis of Comparison (TAF/yr)
		CVP M&I ^a Contracts (maximum ^a)	Water Rights (maximum)	Diversion Limit (maximum capacity)
Placer County Water Agency	Auburn Dam Site	–	65.0	65.0
Total		0	65.0	65.0
Sacramento Suburban Water District ^b	Folsom Reservoir	–	0	0
City of Folsom – includes P.L. 101-514		7	27	34
Folsom Prison		–	5	5
San Juan Water District (Placer County)		–	25	25
San Juan Water District (Sac County) – includes P.L. 101-514	Folsom Reservoir	24.2	33	57.2
El Dorado Irrigation District		7.55	17	24.55
City of Roseville		32	30	62.0
Placer County Water Agency		35	–	35
El Dorado County – P.L.101-514		15	–	15
Total		120.8	137.0	257.8

Appendix 5A: CalSim II and DSM2 Modeling Simulations and Assumptions

	Diversion Location	No Action Alternative and Second Basis of Comparison (TAF/yr)	No Action Alternative and Second Basis of Comparison (TAF/yr)	No Action Alternative and Second Basis of Comparison (TAF/yr)
		CVP M&I ^a Contracts (maximum ^a)	Water Rights (maximum)	Diversion Limit (maximum capacity)
So. Cal WC/Arden Cordova WC	Folsom South Canal	–	5	5
California Parks and Recreation		5	–	5
SMUD		30	15	45
Canal Losses		–	1	1
Total		35	21	56
City of Sacramento ^c	Lower American River	–	225.6	225.6
Carmichael Water District		–	12	12
Total		0	237.6	237.6
Total American River Diversions		155.8	460.6	616.4
Sacramento River Diversions				
City of Sacramento	Lower Sacramento River	–	86.19	86.19
Sacramento County Water Agency		30	–	30
Sacramento County Water Agency—P.L. 101-514		15	–	15
Sacramento County Water Agency—water rights and acquisitions		–	Varies ^d , average 32.58	Varies ^d , average 32.58

	Diversion Location	No Action Alternative and Second Basis of Comparison (TAF/yr)	No Action Alternative and Second Basis of Comparison (TAF/yr)	No Action Alternative and Second Basis of Comparison (TAF/yr)
		CVP M&I ^a Contracts (maximum ^a)	Water Rights (maximum)	Diversion Limit (maximum capacity)
East Bay Municipal Utilities District		133	–	Varies ^e , average 8.2
Total Sacramento River Diversions		178	118.8	172.0
Total		333.8	579.4	788.4

Notes:

- a. When the CVP Contract quantity exceeds the quantity of the Diversion Limit minus the Water Right (if any), the diversion modeled is the quantity allocated to the CVP Contract (based on the CVP contract quantity shown times the CVP M&I allocation percentage) plus the Water Right (if any), but with the sum limited to the quantity of the Diversion Limit
- b. Diversion is only allowed if and when Mar-Nov Folsom Unimpaired Inflow (FUI) exceeds 1,600 TAF
- c. When the Hodge single dry year criteria is triggered, Mar-Nov FUI falls below 400 TAF, diversion on the American River is limited to 50 TAF/yr; based on monthly Hodge flow limits assumed for the American, diversion on the Sacramento River may be increased to 223 TAF due to reductions of diversions on American River
- d. SCWA targets 68 TAF of surface water supplies annually. The portion unmet by CVP contract water is assumed to come from two sources:
 - (1) Delta “excess” water- averages 16.5 TAF annually, but varies according to availability. SCWA is assumed to divert excess flow when it is available, and when there is available pumping capacity.
 - (2) “Other” water- derived from transfers and/or other appropriated water, averaging 14.8 TAF annually but varying according remaining unmet demand.
- e. EBMUD CVP diversions are governed by the Amendatory Contract, stipulating:
 - (1) 133 TAF maximum diversion in any given year
 - (2) 165 TAF maximum diversion amount over any 3 year period
 - (3) Diversions allowed only when EBMUD total storage drops below 500 TAF
 - (4) 155 cfs maximum diversion rate

1 **5A.B7 Delivery Specifications**

2 This section lists the CVP and SWP contract amounts and other water rights
3 assumptions used in the EIS No Action Alternative and No Action Alternative
4 CalSim II simulations (Tables 5A.B.23 through 5A.B.27).

5 **5A.B8 USFWS RPA Implementation**

6 The information included in this section is consistent with what was provided to
7 and agreed upon by the lead agencies in the technical memorandum,
8 “Representation of U.S. Fish and Wildlife Service Biological Opinion Reasonable
9 and Prudent Alternative Actions for CalSim II Planning Studies” on February 10,
10 2010 (updated May 18, 2010).

11 **5A.B8.1 Representation of U.S. Fish and Wildlife Service Biological**
12 **Opinion Reasonable and Prudent Alternative Actions for**
13 **CalSim II Planning Studies**

14 The USFWS BO was released on December 15, 2008. To develop CalSim II
15 modeling assumptions for the RPA in the BO, DWR led a series of meetings that
16 involved members of fisheries and project agencies. The purpose for establishing
17 this group was to prepare the assumptions and CalSim II implementations to
18 represent the RPAs in Existing and Future Condition CalSim II simulations for
19 future planning studies.

20 This memorandum summarizes the approach that resulted from these meetings
21 and the modeling assumptions that were laid out by the group. The scope of this
22 memorandum is limited to the December 15, 2008 BO. Unless otherwise
23 indicated, all descriptive information of the RPAs is taken from Appendix B of
24 the BO.

25 Table 5A.B.28 lists the participants that contributed to the meetings and
26 information summarized in this document.

27 The RPAs in the USFWS BO are based on physical and biological phenomena
28 that do not lend themselves to simulations using a monthly time step. Much
29 scientific and modeling judgment has been employed to represent the
30 implementation of the RPAs. The group believes the logic put into CalSim II
31 represents the RPAs as best as possible at this time, given the scientific
32 understanding of environmental factors enumerated in the BO and the limited
33 historical data for some of these factors.

1 **Table 5A.B.23 Delta – Future Conditions**

CVP/SWP Contractor	Geographic Location	Water Right (TAF/yr)	SWP Table A Amount (TAF)		SWP Article 21 Demand (TAF/mon)	CVP Water Service Contracts (TAF/yr)	
			Ag	M&I		AG	M&I
North Delta							
City of Vallejo	City of Vallejo	–	–	–	–	–	16.0
CCWD*	Contra Costa County	–	–	–	–	–	195.0
Napa County FC&WCD	North Bay Aqueduct	–	–	29.03	1.0	–	–
Solano County WA	North Bay Aqueduct	–	–	47.51	1.0	–	–
Fairfield, Vacaville, and Benicia Agreement	North Bay Aqueduct	31.60	–	–	–	–	–
City of Antioch	City of Antioch	18.0	–	–	–	–	–
Total North Delta		49.6	0.0	76.5	2.0	0.0	211.0
South Delta							
Delta Water Supply Project	City of Stockton	32.4	–	–	–	–	–
Total South Delta		32.4	0.0	0.0	0.0	0.0	0.0
Total		82.0	0.0	76.5	2.0	0.0	211.0

1 **Table 5A.B.24 CVP North-of-the-Delta – Future Conditions**

CVP Contractor	Geographic Location	CVP Water Service Contracts (TAF/yr)		Settlement/Exchange Contractor (TAF/yr)	Water Rights/ Non-CVP (TAF/yr)	Level 2 Refuges* (TAF/yr)
		AG	M&I			
Anderson Cottonwood ID	Sacramento River Redding Subbasin	–	–	128.0	–	–
Clear Creek C.S.D.		13.8	1.5	–	–	–
Bella Vista WD		22.1	2.4	–	–	–
Shasta C.S.D.		–	1.0	–	–	–
Sac R. Misc. Users		–	–	3.4	–	–
Redding, City of		–	–	21.0	–	–
City of Shasta Lake		2.5	0.3	–	–	–
Mountain Gate C.S.D.			0.4	–	–	–
Shasta County Water Agency		0.5	0.5	–	–	–
Redding, City of/Buckeye		–	6.1	–	–	–
Total		38.9	12.2	152.4		0.0
Corning WD	Corning Canal	23.0	–	–	–	–
Proberta WD		3.5	–	–	–	–
Thomes Creek WD		6.4	–	–	–	–
Total		32.9	0.0	0.0	–	0.0
Kirkwood WD	Tehama-Colusa Canal	2.1	–	–	–	–
Glide WD		10.5	–	–	–	–
Kanawha WD		45.0	–	–	–	–
Orland-Artois WD		53.0	–	–	–	–

Appendix 5A: CalSim II and DSM2 Modeling Simulations and Assumptions

CVP Contractor	Geographic Location	CVP Water Service Contracts (TAF/yr)		Settlement/Exchange Contractor (TAF/yr)	Water Rights/ Non-CVP (TAF/yr)	Level 2 Refuges* (TAF/yr)
		AG	M&I			
Colusa, County of		20.0	–	–	–	–
Colusa County WD		62.2	–	–	–	–
Davis WD		4.0	–	–	–	–
Dunnigan WD		19.0	–	–	–	–
La Grande WD		5.0	–	–	–	–
Westside WD		65.0	–	–	–	–
Total		285.8	0.0	0.0	0.0	–
Sac. R. Misc. Users	Sacramento River	–	–	1.5	–	–
Glenn Colusa ID	Glenn-Colusa Canal	–	–	441.5	–	–
		–	–	383.5	–	–
Sacramento NWR		–	–	–	–	53.4
Delevan NWR		–	–	–	–	24.0
Colusa NWR		–	–	–	–	28.8
Colusa Drain M.W.C.	Colusa Basin Drain	–	–	7.7	–	–
		–	–	62.3	–	–
Total		0.0	0.0	895.0	–	106.2
Princeton-Cordova-Glenn ID	Sacramento River	–	–	67.8	–	–
Provident ID		–	–	54.7	–	–
Maxwell ID		–	–	1.8	–	–
		–	–	16.2	–	–

Appendix 5A: CalSim II and DSM2 Modeling Simulations and Assumptions

CVP Contractor	Geographic Location	CVP Water Service Contracts (TAF/yr)		Settlement/Exchange Contractor (TAF/yr)	Water Rights/ Non-CVP (TAF/yr)	Level 2 Refuges* (TAF/yr)
		AG	M&I			
Sycamore Family Trust		-	-	31.8	-	-
Roberts Ditch IC		-	-	4.4	-	-
Sac R. Misc. Users ^b		-	-	4.9	-	-
		-	-	9.5	-	-
Total		0.0	0.0	191.2	-	0.0
Reclamation District 108	Sacramento River	-	-	12.9	-	-
		-	-	219.1	-	-
River Garden Farms		-	-	29.8	-	-
Meridian Farms WC		-	-	35.0	-	-
Pelger Mutual WC		-	-	8.9	-	-
Reclamation District 1004		-	-	71.4	-	-
Carter MWC		-	-	4.7	-	-
Sutter MWC		-	-	226.0	-	-
Tisdale Irrigation & Drainage Co.		-	-	9.9	-	-
Sac R. Misc. Users		-	-	103.4	-	-
	-	-	0.9	-	-	
Feather River WD export	20.0	-	-	-	-	
Total	20.0	0.0	722.1	-	0.0	
Sutter NWR	Sutter bypass water for Sutter NWR	-	-	-	-	25.9
Gray Lodge WMA	Feather River	-	-	-	-	41.4
Butte Sink Duck Clubs		-	-	-	-	15.9
Total		0.0	0.0	0.0	-	83.2

Appendix 5A: CalSim II and DSM2 Modeling Simulations and Assumptions

CVP Contractor	Geographic Location	CVP Water Service Contracts (TAF/yr)		Settlement/Exchange Contractor (TAF/yr)	Water Rights/ Non-CVP (TAF/yr)	Level 2 Refuges* (TAF/yr)
		AG	M&I			
Sac. R. Misc. Users	Sacramento River	-	-	56.8	-	-
City of West Sacramento		-	-	23.6	-	-
Davis-Woodland Water Supply Project		DSA 65	-	-	-	-
Total		0.0	0.0	80.4	-	0.0
Sac R. Misc. Users	Lower Sacramento River	-	-	4.8	-	-
Natomas Central MWC		-	-	120.2	-	-
Pleasant Grove-Verona MWC		-	-	26.3	-	-
City of Sacramento		-	0.0	-	0.0	-
PCWA (Water Rights)		-	0.0	-	0.0	-
Total		0.0	0.0	151.3	0.0	-
Total CVP North-of-Delta		377.6	12.2	2,193.8	0.0	189.4

1 Notes:

2 * Level 4 Refuge water needs are not included.

1 **Table 5A.B.25 CVP South-of-the-Delta – Future Conditions**

CVP Contractor	Geographic Location	CVP Water Service Contracts (TAF/yr)		Settlement/ Exchange Contractor (TAF/yr)	Water Rights/ Non-CVP (TAF/yr)	Level 2 Refuges* (TAF/yr)	Losses (TAF/yr)
		AG	M&I				
Byron-Bethany ID	Upper DMC	20.6		–	–	–	–
Tracy, City of		–	10.0	–	–	–	–
		–	5.0	–	–	–	–
		–	5.0	–	–	–	–
Banta Carbona ID		20.0		–	–	–	–
Total	40.6	20.0	0.0	0.0	0.0	0.0	
Del Puerto WD	Upper DMC	12.1	–	–	–	–	–
Davis WD		5.4	–	–	–	–	–
Foothill WD		10.8	–	–	–	–	–
Hospital WD		34.1	–	–	–	–	–
Kern Canon WD		7.7	–	–	–	–	–
Mustang WD		14.7	–	–	–	–	–
Orestimba WD		15.9	–	–	–	–	–
Quinto WD		8.6	–	–	–	–	–
Romero WD		5.2	–	–	–	–	–
Salado WD		9.1	–	–	–	–	–
Sunflower WD		16.6	–	–	–	–	–
West Stanislaus WD		50.0	–	–	–	–	–
Patterson WD		16.5	–	–	–	6.0	–
Total		206.7	0.0	0.0	0.0	6.0	0.0

Appendix 5A: CalSim II and DSM2 Modeling Simulations and Assumptions

CVP Contractor	Geographic Location	CVP Water Service Contracts (TAF/yr)		Settlement/ Exchange Contractor (TAF/yr)	Water Rights/ Non-CVP (TAF/yr)	Level 2 Refuges* (TAF/yr)	Losses (TAF/yr)
		AG	M&I				
Upper DMC Loss	Upper DMC	–	–	–	–	–	18.5
Panoche WD	Lower DMC Volta	6.6	–	–	–	–	–
San Luis WD		65.0	–	–	–	–	–
Laguna WD		0.8	–	–	–	–	–
Eagle Field WD		4.6	–	–	–	–	–
Mercy Springs WD		2.8	–	–	–	–	–
Oro Loma WD		4.6	–	–	–	–	–
Total		84.4	0.0	0.0	0.0	0.0	0.0
Central California ID		Lower DMC Volta	–	–	140.0	–	–
Grasslands via CCID	Lower DMC Volta	–	–	–	–	81.8	–
Los Banos WMA		–	–	–	–	11.2	–
Kesterson NWR	Lower DMC Volta	–	–	–	–	10.5	–
Freitas – SJBAP		–	–	–	–	6.3	–
Salt Slough – SJBAP		–	–	–	–	8.6	–
China Island – SJBAP		–	–	–	–	7.0	–
Volta WMA		–	–	–	–	13.0	–
Grassland via Volta Wasteway		–	–	–	–	23.2	–
Total		0.0	0.0	140.0	0.0	161.5	0.0

Appendix 5A: CalSim II and DSM2 Modeling Simulations and Assumptions

CVP Contractor	Geographic Location	CVP Water Service Contracts (TAF/yr)		Settlement/ Exchange Contractor (TAF/yr)	Water Rights/ Non-CVP (TAF/yr)	Level 2 Refuges* (TAF/yr)	Losses (TAF/yr)
		AG	M&I				
Fresno Slough WD	San Joaquin River at Mendota Pool	4.0	–	–	0.9	–	–
James ID		35.3	–	–	9.7	–	–
Coelho Family Trust		2.1	–	–	1.3	–	–
Tranquillity ID		13.8	–	–	20.2	–	–
Tranquillity PUD		0.1	–	–	0.1	–	–
Reclamation District 1606		0.2	–	–	0.3	–	–
Central California ID		–	–	392.4	–	–	–
Columbia Canal Co.		–	–	59.0	–	–	–
Firebaugh Canal Co.		–	–	85.0	–	–	–
San Luis Canal Co.		–	–	23.6	–	–	–
M.L. Dudley Company		–	–	–	2.3	–	–
Grasslands WD		–	–	–	–	29.0	–
Mendota WMA		–	–	–	–	27.6	–
Losses		–	–	–	–	–	101.5
Total			55.5	0.0	560.0	34.8	56.6
San Luis Canal Co.	San Joaquin River at Sack Dam	–	–	140.0	–	–	–
Grasslands WD		–	–	–	–	2.3	–
Los Banos WMA		–	–	–	–	12.4	–
San Luis NWR		–	–	–	–	19.5	–
West Bear Creek NWR		–	–	–	–	7.5	–
East Bear Creek NWR		–	–	–	–	8.9	–
Total			0.0	0.0	140.0	0.0	50.6

Appendix 5A: CalSim II and DSM2 Modeling Simulations and Assumptions

CVP Contractor	Geographic Location	CVP Water Service Contracts (TAF/yr)		Settlement/ Exchange Contractor (TAF/yr)	Water Rights/ Non-CVP (TAF/yr)	Level 2 Refuges* (TAF/yr)	Losses (TAF/yr)
		AG	M&I				
San Benito County WD (Ag)	San Felipe	35.6	–	–	–	–	–
Santa Clara Valley WD (Ag)		33.1	–	–	–	–	–
Pajaro Valley WD		6.3	–	–	–	–	–
San Benito County WD (M&I)		–	8.3	–	–	–	–
Santa Clara Valley WD (M&I)		–	119.4	–	–	–	–
Total		74.9	127.7	0.0	0.0	0.0	0.0
San Luis WD	CA reach 3	60.1	–	–	–	–	–
CA, State Parks and Rec		2.3	–	–	–	–	–
Affonso/Los Banos Gravel Co.		0.3	–	–	–	–	–
Total		62.6	0.0	0.0	0.0	0.0	0.0
Panoche WD	CVP Dos Amigos Pumping Plant/ CA reach 4	87.4	–	–	–	–	–
Pacheco WD		10.1	–	–	–	–	–
Total		97.5	0.0	0.0	0.0	0.0	0.0
Westlands WD (Centinella)	CA reach 4	2.5	–	–	–	–	–
Westlands WD (Broadview WD)		27.0	–	–	–	–	–
Westlands WD (Mercy Springs WD)		4.2	–	–	–	–	–
Westlands WD (Widern WD)		3.0	–	–	–	–	–
Total		36.7	0.0	0.0	0.0	0.0	0.0

Appendix 5A: CalSim II and DSM2 Modeling Simulations and Assumptions

CVP Contractor	Geographic Location	CVP Water Service Contracts (TAF/yr)		Settlement/ Exchange Contractor (TAF/yr)	Water Rights/ Non-CVP (TAF/yr)	Level 2 Refuges* (TAF/yr)	Losses (TAF/yr)
		AG	M&I				
Westlands WD: CA Joint Reach 4	CA reach 4	219.0	–	–	–	–	–
Westlands WD: CA Joint Reach 5	CA reach 5	570.0	–	–	–	–	–
Westlands WD: CA Joint Reach 6	CA reach 6	219.0	–	–	–	–	–
Westlands WD: CA Joint Reach 7	CA reach 7	142.0	–	–	–	–	–
Total		1150.0	0.0	0.0	0.0	0.0	0.0
Avenal, City of	CA reach 7	–	3.5	–	3.5	–	–
Coalinga, City of		–	10.0	–	–	–	–
Huron, City of		–	3.0	–	–	–	–
Total		0.0	16.5	0.0	3.5	0.0	0.0
CA Joint Reach 3 – Loss	CVP Dos Amigos PP/CA reach 3	–	–	–	–	–	2.5
CA Joint Reach 4 – Loss	CA reach 4	–	–	–	–	–	10.1
CA Joint Reach 5 – Loss	CA reach 5	–	–	–	–	–	30.1
CA Joint Reach 6 – Loss	CA reach 6	–	–	–	–	–	12.5
CA Joint Reach 7 – Loss	CA reach 7	–	–	–	–	–	8.5
Total		0.0	0.0	0.0	0.0	0.0	63.7
Cross Valley Canal – CVP	CA reach 14	–	–	–	–	–	–
Fresno, County of		3.0	–	–	–	–	–
Hills Valley ID-Amendatory		3.3	–	–	–	–	–
Kern-Tulare WD		40.0	–	–	–	–	–
Lower Tule River ID		31.1	–	–	–	–	–

Appendix 5A: CalSim II and DSM2 Modeling Simulations and Assumptions

CVP Contractor	Geographic Location	CVP Water Service Contracts (TAF/yr)		Settlement/ Exchange Contractor (TAF/yr)	Water Rights/ Non-CVP (TAF/yr)	Level 2 Refuges* (TAF/yr)	Losses (TAF/yr)
		AG	M&I				
Pixley ID		31.1	–	–	–	–	–
Rag Gulch WD		13.3	–	–	–	–	–
Tri-Valley WD		1.1	–	–	–	–	–
Tulare, County of		5.3	–	–	–	–	–
Kern NWR		–	–	–	–	11.0	–
Pixley NWR		–	–	–	–	1.3	–
Total		128.3	0.0	0.0	0.0	12.3	0.0
Total CVP South-of-Delta		1,937.1	164.2	840.0	44.3	281.0	183.7

- 1 Notes:
- 2 *Level 4 Refuge water supplies are not included.

1 **Table 5A.B.26 SWP North-of-the-Delta – Future Conditions**

SWP CONTRACTOR	Geographic Location	FRSA Amount (TAF)	Water Right (TAF/yr)	Table A Amount (TAF)		Article 21 Demand (TAF/mon)	Other (TAF/yr)
				Ag	M&I		
Feather River							
Palermo	FRSA	–	17.6	–	–	–	–
County of Butte	Feather River	–	–	–	27.5	–	–
Thermalito	FRSA	–	8.0	–	–	–	–
Western Canal	FRSA	150.0	145.0	–	–	–	–
Joint Board	FRSA	550.0	5.0	–	–	–	–
City of Yuba City	Feather River	–	–	–	9.6	–	–
Feather WD	FRSA	17.0	–	–	–	–	–
Garden, Oswald, Joint Board	FRSA	–	–	–	–	–	–
Garden	FRSA	12.9	5.1	–	–	–	–
Oswald	FRSA	2.9	–	–	–	–	–
Joint Board	FRSA	50.0	–	–	–	–	–
Plumas, Tudor	FRSA	–	–	–	–	–	–
Plumas	FRSA	8.0	6.0	–	–	–	–
Tudor	FRSA	5.1	0.2	–	–	–	–
Total Feather River Area		795.8	186.9	0.0	37.1	–	–

Appendix 5A: CalSim II and DSM2 Modeling Simulations and Assumptions

SWP CONTRACTOR	Geographic Location	FRSA Amount (TAF)	Water Right (TAF/yr)	Table A Amount (TAF)		Article 21 Demand (TAF/mon)	Other (TAF/yr)
				Ag	M&I		
Other							
Yuba County Water Agency	Yuba River	-	-	-	-	-	Variable
		-	-	-	-	-	333.6
Camp Far West ID	Yuba River	-	-	-	-	-	12.6
Bear River Exports	American R/DSA70	-	-	-	-	-	Variable
		-	-	-	-	-	95.2
Feather River Exports to American River (left bank to DSA70)	American R/DSA70	-	11.0	-	-	-	-

1 **Table 5A.B.27 SWP South-of-the-Delta –Future Conditions**

SWP Contractor	Geographic Location	Table A Amount (TAF)		Article 21 Demand (TAF/mon)	Losses (TAF/yr)
		Ag	M&I		
Alameda Co. FC&WCD, Zone 7	SBA reaches 1-4	–	47.60	1.00	–
	SBA reaches 5-6	–	33.02	None	–
	Total	–	80.62	1.00	–
Alameda County WD	SBA reaches 7-8	–	42.00	1.00	–
Santa Clara Valley WD	SBA reach 9	–	100.00	4.00	–
Oak Flat WD	CA reach 2A	5.70	–	None	–
County of Kings	CA reach 8C	9.31	–	None	–
Dudley Ridge WD	CA reach 8D	50.34	–	1.00	–
Empire West Side ID	CA reach 8C	2.00	–	1.00	–
Kern County Water Agency	CA reaches 3, 9-13B	608.86	134.60	None	–
	CA reaches 14A-C	99.20	–	180.00	–
	CA reaches 15A-16A	59.40	–	None	–
	CA reach 31A	80.67	–	None	–
	Total	848.13	134.60	180.00	–
Tulare Lake Basin WSD	CA reaches 8C-8D	88.92	–	15.00	–
San Luis Obispo Co. FC&WCD	CA reaches 33A-35	–	25.00	None	–
Santa Barbara Co. FC&WCD	CA reach 35	–	45.49	None	–
Antelope Valley-East Kern WA	CA reaches 19-20B, 22A-B	–	141.40	1.00	–
Castaic Lake WA	CA reach 31A	12.70	–	1.00	–
	CA reach 30	–	82.50	None	–
	Total	12.70	82.50	1.00	–
Coachella Valley WD	CA reach 26A	–	138.35	2.00	–

Appendix 5A: CalSim II and DSM2 Modeling Simulations and Assumptions

SWP Contractor	Geographic Location	Table A Amount (TAF)		Article 21 Demand (TAF/mon)	Losses (TAF/yr)
		Ag	M&I		
Crestline-Lake Arrowhead WA	CA reach 24	–	5.80	None	–
Desert WA	CA reach 26A	–	55.75	5.00	–
Littlerock Creek ID	CA reach 21	–	2.30	None	–
Mojave WA	CA reaches 19, 22B-23	–	82.80	None	–
Metropolitan WDSC	CA reach 26A	–	148.67	90.70	–
	CA reach 30	–	756.69	74.80	–
	CA reaches 28G-H	–	102.71	27.60	–
	CA reach 28J	–	903.43	6.90	–
	Total	–	1911.50	200.00	–
Palmdale WD	CA reaches 20A-B	–	21.30	None	–
San Bernardino Valley MWD	CA reach 26A	–	102.60	None	–
San Gabriel Valley MWD	CA reach 26A	–	28.80	None	–
San Geronio Pass WA	CA reach 26A	–	17.30	None	–
Ventura County FCD	CA reach 29H	–	3.15	None	–
	CA reach 30	–	16.85	None	–
	Total	–	20.00	–	–

Appendix 5A: CalSim II and DSM2 Modeling Simulations and Assumptions

SWP Contractor	Geographic Location	Table A Amount (TAF)		Article 21 Demand (TAF/mon)	Losses (TAF/yr)
		Ag	M&I		
SWP Losses	CA reaches 1-2	–	–	–	7.70
	SBA reaches 1-9	–	–	–	0.60
	CA reach 3	–	–	–	10.80
	CA reach 4	–	–	–	2.60
	CA reach 5	–	–	–	3.90
	CA reach 6	–	–	–	1.20
	CA reach 7	–	–	–	1.60
	CA reaches 8C-13B	–	–	–	11.90
	Wheeler Ridge Pumping Plant and CA reaches 14A-C	–	–	–	3.60
	Chrisman Pumping Plant and CA reaches 15A-18A	–	–	–	1.80
	Pearblossom Pumping Plant and CA reaches 17-21	–	–	–	5.10
	Mojave Pumping Plant and CA reaches 22A-23	–	–	–	4.00
	REC and CA reaches 24-28J	–	–	–	1.40
	CA reaches 29A-29F	–	–	–	1.90
	Castaic PWP and CA reach 29H	–	–	–	3.10
	REC and CA reach 30	–	–	–	2.40
Total		–	–	–	63.60
Total		1,017.10	3,038.11	412.00	63.60

1 **Table 5A.B.28 Meeting Participants**

Aaron Miller/DWR Steve Ford/DWR Randi Field/Reclamation Gene Lee/Reclamation Lenny Grimaldo/Reclamation	Derek Hilts/USFWS Steve Detwiler/USFWS Matt Nobriga/CDFW Jim White/CDFW Craig Anderson/NMFS
Parviz Nader-Tehrani/DWR Erik Reyes/DWR Sean Sou/DWR	Robert Leaf/CH2M HILL Derya Sumer/CH2M HILL

2 The simulated OMR flow conditions and CVP and SWP Delta export operations,
 3 resulting from these assumptions, are believed to be a reasonable representation of
 4 conditions expected to prevail under the RPAs over large spans of years (refer to
 5 CalSim II modeling results for more details on simulated operations). Actual
 6 OMR flow conditions and Delta export operations will differ from simulated
 7 operations for numerous reasons, including having near real-time knowledge
 8 and/or estimates of turbidity, temperature, and fish spatial distribution that are
 9 unavailable for use in CalSim II over a long period of record. Because these
 10 factors and others are believed to be critical for smelt entrainment risk
 11 management, the USFWS adopted an adaptive process in defining the RPAs.
 12 Given the relatively generalized representation of the RPAs, assumed for
 13 CalSim II modeling, much caution is required when interpreting outputs from the
 14 model.

15 **5A.B8.1.1 Action 1: Adult Delta Smelt Migration and Entrainment (RPA**
 16 **Component 1, Action 1 – First Flush)**

17 **5A.B8.1.1.1 Action 1 Summary:**

18 **Objective:** A fixed duration action to protect pre-spawning adult Delta Smelt
 19 from entrainment during the first flush, and to provide advantageous
 20 hydrodynamic conditions early in the migration period.

21 **Action:** Limit exports so that the average daily combined OMR flow is no more
 22 negative than -2,000 cfs for a total duration of 14 days, with a 5-day running
 23 average no more negative than -2,500 cfs (within 25 percent).

24 **Timing:**

25 **Part A:** December 1 to December 20 – The Smelt Working Group (SWG) may
 26 recommend a start date to the USFWS based upon an examination of turbidity
 27 data from Prisoner’s Point, Holland Cut, Victoria Canal and salvage data from
 28 CVP and SWP (see below), and other parameters important to the protection of
 29 Delta Smelt including (but not limited to) preceding conditions of X2, the Fall
 30 Midwater Trawl Survey (FMWT), and river flows. The USFWS will make the
 31 final determination.

32 **Part B:** After December 20 – The action will begin if the 3-day average turbidity
 33 at Prisoner’s Point, Holland Cut, and Victoria Canal exceeds 12 nephelometric
 34 turbidity units (NTU). However the SWG can recommend a delayed start or

1 interruption based on other conditions such as Delta inflow that may affect
2 vulnerability to entrainment.

3 **Triggers (Part B):**

4 **Turbidity:** Three-day average of 12 NTU or greater at all three turbidity stations
5 (Prisoner's Point, Holland Cut, and Victoria Canal)

6 OR

7 **Salvage:** Three days of Delta Smelt salvage after December 20 at either facility or
8 cumulative daily salvage count that is above a risk threshold based upon the daily
9 salvage index approach reflected in a daily salvage index value greater than or
10 equal to 0.5 (daily Delta Smelt salvage greater than one-half of the prior year
11 FMWT index value).

12 The window for triggering Action 1 concludes when either off-ramp condition
13 described below is met. These off-ramp conditions may occur without Action 1
14 ever being triggered. If this occurs, then Action 3 is triggered, unless the USFWS
15 concludes on the basis of the totality of available information that Action 2 should
16 be implemented instead.

17 **Off-ramps:**

18 **Temperature:** Water temperature reaches 12 degrees Celsius (°C) based on a
19 three station daily mean at the temperature stations Mossdale, Antioch, and
20 Rio Vista

21 OR

22 **Biological:** Onset of spawning (presence of spent females in the Spring Kodiak
23 Trawl Survey [SKT] or at Banks or Jones).

24 **5A.B8.1.1.2 Action 1 Assumptions for CalSim II Modeling Purposes:**

25 An approach was selected based on hydrologic and assumed turbidity conditions.
26 Under this general assumption, Part A of the action was never assumed because,
27 on the basis of historical salvage data, it was considered unlikely or rarely to
28 occur. Part B of the action was assumed to occur if triggered by turbidity
29 conditions. This approach was believed to tend to a more conservative
30 interpretation of the frequency, timing, and extent of this action. The assumptions
31 used for modeling are as follows:


32 **Action:** Limit exports so that the average daily OMR flow is no more negative
33 than -2,000 cfs for a total duration of 14 days, with a 5-day running average no
34 more negative than 2,500 cfs (within 25 percent of the monthly criteria).

35 **Timing:** If turbidity-trigger conditions first occur in December, then the action
36 starts on December 21; if turbidity-trigger conditions first occur in January, then
37 the action starts on January 1; if turbidity-trigger conditions first occur in
38 February, then the action starts on February 1; and if turbidity-trigger conditions
39 first occur in March, then the action starts on March 1. It is assumed that once the
40 action is triggered, it continues for 14 days.

1 **Triggers:** Only an assumed turbidity trigger that is based on hydrologic outputs
 2 was considered. A surrogate salvage trigger or indicator was not included
 3 because there was no way to model it.

4 **Turbidity:** If the monthly average unimpaired Sacramento River Index (four-
 5 river index: sum of Sacramento, Yuba, Feather, and American Rivers) exceeds
 6 20,000 cfs, then it is assumed that an event, in which the 3-day average turbidity
 7 at Hood exceeds 12 NTU, has occurred within the month. It is assumed that an
 8 event at Sacramento River is a reasonable indicator of this condition occurring,
 9 within the month, at all three turbidity stations: Prisoner’s Point, Holland Cut, and
 10 Victoria Canal.

11 A chart showing the relationship between turbidity at Hood (number of days with
 12 turbidity is greater than 12 NTU) and Sacramento River Index (sum of monthly
 13 flow at four stations on the Sacramento, Feather, Yuba and American Rivers,
 14 from 2003 to 2006) is shown on Figure 5A.B.1. For months when average
 15 Sacramento River Index is between 20,000 cfs and 25,000 cfs, a transition is
 16 observed in number of days with Hood turbidity greater than 12 NTU. For
 17 months when average Sacramento River Index is above 25,000 cfs, Hood
 18 turbidity was always greater than 12 NTU for as many as 5 days or more within
 19 the month in which the flow occurred. For a conservative approach, 20,000 cfs is
 20 used as the threshold value.

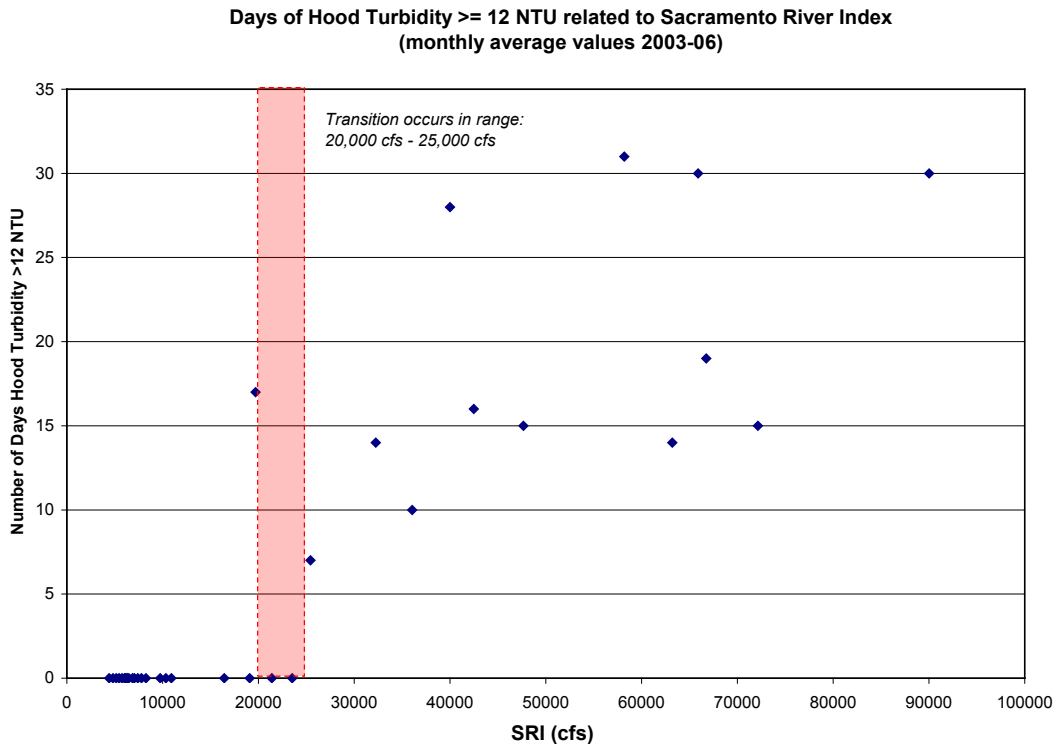


21 **Figure 5A.B.1 Relationship between Turbidity at Hood and Sacramento River Index**

22 **Salvage:** It is assumed that salvage would occur when first flush occurs.

1 **Off-ramps:** Only temperature-based off-ramping is considered. A surrogate
 2 biological off-ramp indicator was not included.

3 Temperature: Because the water temperature data at the three temperature stations
 4 (Antioch, Mossdale, and Rio Vista) are only available for years after 1984,
 5 another parameter was sought for use as an alternative indicator. It is observed
 6 that monthly average air temperature at Sacramento Executive Airport generally
 7 trends with the three-station average water temperature (see Figure 5A.B.2).
 8 Using this alternative indicator, monthly average air temperature is assumed to
 9 occur in the middle of the month, and values are interpolated on a daily basis to
 10 obtain daily average water temperature. Using the correlation between air and
 11 water temperature, estimated daily water temperatures are estimated from the
 12 82-year monthly average air temperature. Dates when the three-station average
 13 temperature reaches 12°C are recorded and used as input in CalSim II. A 1:1
 14 correlation was used for simplicity instead of using the trend line equation
 15 illustrated on Figure 5A.B.2.

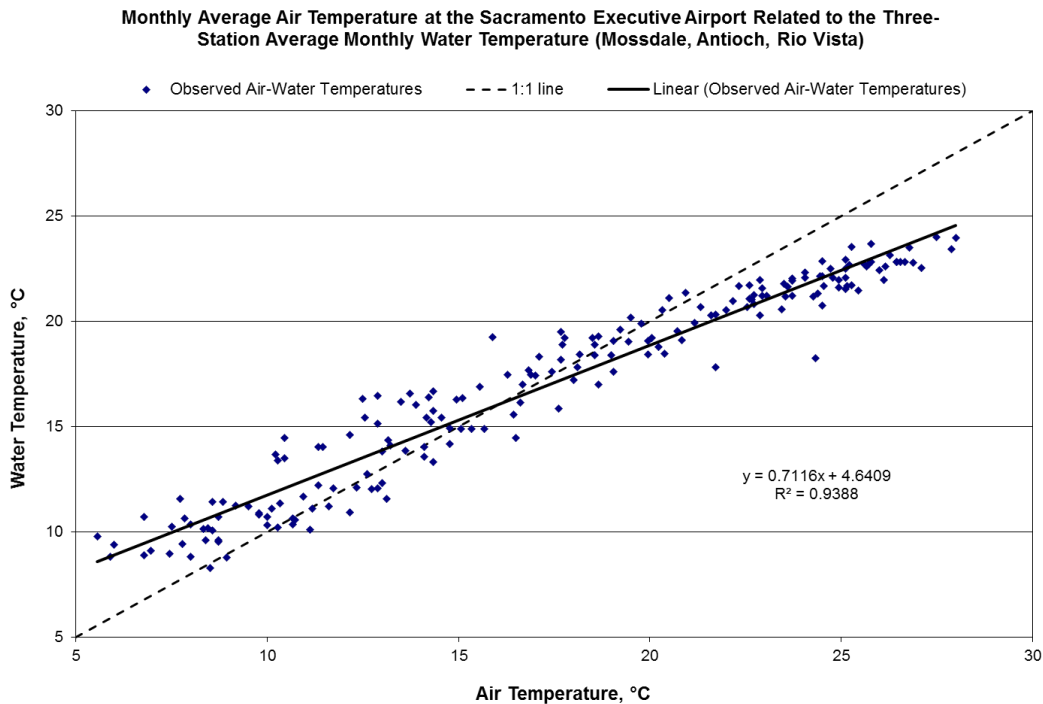

16 **Figure 5A.B.2 Relationship between Monthly Average Air Temperature at the**
 17 **Sacramento Executive Airport and the Three-station Average Monthly Water**
 18 **Temperature**

19 **Other Modeling Considerations:** For monthly analysis for the month of
 20 December (in which Action 1 does not begin until December 21), a background
 21 OMR flow must be assumed for the purpose of calculating a day-weighted
 22 average for implementing a partial-month action condition. When necessary, the
 23 background OMR flow for December was assumed to be -8,000 cfs.

1 For the additional condition to meet a 5-day running average no more negative
 2 than 2,500 cfs (within 25 percent), Paul Hutton's equation is used. Hutton
 3 concluded that with stringent OMR standards (1,250 to 2,500 cfs), the 5-day
 4 average would control more frequently than the 14-day average, but it is less
 5 likely to control at higher flows. Therefore, the CalSim II implementation
 6 includes both a 14-day (approximately monthly average) and a 5-day average
 7 flow criteria based on Hutton's methodology.

8 **Rationale:** The following is an overall summary of the rationale for the preceding
 9 interpretation of RPA Action 1.

10 December 1 to December 20 for initiating Action 1 is not considered because
 11 seasonal peaks of Delta Smelt salvage are rare prior to December 20. Adult Delta
 12 Smelt spawning migrations often begin following large precipitation events that
 13 happen after mid-December.

14 Salvage of adult Delta Smelt often corresponds with increases in turbidity and
 15 exports. On the basis of the above discussion and Figure 5A.B.2, Sacramento
 16 River Index greater than 25,000 cfs is assumed to be an indicator of turbidity
 17 trigger being reached at all three turbidity stations: Prisoner's Point, Holland Cut,
 18 and Victoria Canal. Most sediment enters the Delta from the Sacramento River
 19 during flow pulses; therefore, a flow indicator based on only Sacramento River
 20 flow is used.

21 The 12°C threshold for the off-ramp criterion is a conservative estimate of when
 22 Delta Smelt larvae begin successfully hatching. Once hatched, the larvae move
 23 into the water column where they are potentially vulnerable to entrainment.

24 Results: Using these assumptions, in a typical CalSim II 82-year simulation (1922
 25 through 2003 hydrologic conditions), Action 1 will occur 29 times in the
 26 December 21 to January 3 period, 14 times in the January 1 to January 14 period,
 27 13 times in the February 1 to February 14 period, and 17 times in the March 1 to
 28 March 14 period. In three of these 17 occurrences (1934, 1991, and 2001),
 29 Action 3 is triggered before Action 1 and therefore Action 1 is bypassed.
 30 Action 1 is not triggered in nine of the 82 years (1924, 1929, 1931, 1955, 1964,
 31 1976, 1977, 1985, and 1994), typically critically dry years. Refer to CalSim II
 32 modeling results for more details on simulated operations of OMR, Delta exports,
 33 and other parameters of interest.

34 **5A.B8.1.2 Action 2: Adult Delta Smelt Migration and Entrainment (RPA** 35 **Component 1, Action 2)**

36 **5A.B8.1.2.1 Action 2 Summary:**

37 **Objective:** An action implemented using an adaptive process to tailor protection
 38 to changing environmental conditions after Action 1. As in Action 1, the intent is
 39 to protect pre-spawning adults from entrainment and, to the extent possible, from
 40 adverse hydrodynamic conditions.

41 **Action:** The range of net daily OMR flows will be no more negative than -1,250
 42 to -5,000 cfs. Depending on extant conditions (and the general guidelines below),

1 specific OMR flows within this range are recommended by the SWG from the
2 onset of Action 2 through its termination (see Adaptive Process description in the
3 BO). The SWG would provide weekly recommendations based upon review of
4 the sampling data, from real-time salvage data at the CVP and SWP, and utilizing
5 most up-to-date technological expertise and knowledge relating population status
6 and predicted distribution to monitored physical variables of flow and turbidity.
7 The USFWS will make the final determination.

8 **Timing:** Beginning immediately after Action 1. Before this date (in time for
9 operators to implement the flow requirement) the SWG will recommend specific
10 requirement OMR flows based on salvage and on physical and biological data on
11 an ongoing basis. If Action 1 is not implemented, the SWG may recommend a
12 start date for the implementation of Action 2 to protect adult Delta Smelt.

13 **Suspension of Action:**

14 Flow: OMR flow requirements do not apply whenever a 3-day flow average is
15 greater than or equal to 90,000 cfs in Sacramento River at Rio Vista and
16 10,000 cfs in San Joaquin River at Vernalis. Once such flows have abated, the
17 OMR flow requirements of the Action are again in place.

18 **Off-ramps:**

19 Temperature: Water temperature reaches 12°C based on a three-station daily
20 average at the temperature stations: Rio Vista, Antioch, and Mossdale.

21 OR

22 Biological: Onset of spawning (presence of a spent female in SKT or at either
23 facility).

24 **5A.B8.1.2.2 Action 2 Assumptions for CalSim II Modeling Purposes:**

25 An approach was selected based on the occurrence of Action 1 and X2 salinity
26 conditions. This approach selects from between two OMR flow tiers depending
27 on the previous month's X2 position, and is never more constraining than an
28 OMR criterion of -3,500 cfs. The assumptions used for modeling are as follows:

29 **Action:** Limit exports so that the average daily OMR flow is no more negative
30 than -3,500 or -5,000 cfs depending on the previous month's ending X2 location
31 (-3,500 cfs if X2 is east of Roe Island, or -5,000 cfs if X2 is west of Roe Island),
32 with a 5-day running average within 25 percent of the monthly criteria (no more
33 negative than -4,375 cfs if X2 is east of Roe Island, or -6,250 cfs if X2 is west of
34 Roe Island).

35 **Timing:** Begins immediately after Action 1 and continues until initiation of
36 Action 3.

37 In a typical CalSim II 82-year simulation, Action 1 was not triggered in nine of
38 the 82 years. In these conditions it is assumed that OMR flow should be
39 maintained no more negative than -5,000 cfs.

40 **Suspension of Action:** A flow peaking analysis, developed by Paul Hutton
41 (2009), is used to determine the likelihood of a 3-day flow average greater than or

1 equal to 90,000 cfs in Sacramento River at Rio Vista and a 3-day flow average
 2 greater than or equal to 10,000 cfs in San Joaquin River at Vernalis occurring
 3 within the month. It is assumed that when the likelihood of these conditions
 4 occurring exceeds 50 percent, Action 2 is suspended for the full month, and OMR
 5 flow requirements do not apply. The likelihood of these conditions occurring is
 6 evaluated each month, and Action 2 is suspended for 1 month at a time whenever
 7 both of these conditions occur.

8 The equations for likelihood (frequency of occurrence) are as follows:

- 9 • Frequency of Rio Vista 3-day flow average > 90,000 cfs:
- 10 – 0 percent when Freeport monthly flow < 50,000 cfs, OR
- 11 – $(0.00289 \times \text{Freeport monthly flow} - 146)$ percent when $50,000 \text{ cfs} \leq$
 12 Freeport plus Yolo Bypass monthly flow $\leq 85,000$ cfs, OR
- 13 – 100 percent when Freeport monthly flow > 85,000 cfs
- 14 • Frequency of Vernalis 3-day flow average > 10,000 cfs:
- 15 – 0 percent when Vernalis monthly flow < 6,000 cfs, OR
- 16 – $(0.00901 \times \text{Vernalis monthly flow} - 49)$ percent when $6,000 \text{ cfs} \leq$ Vernalis
 17 monthly flow $\leq 16,000$ cfs, OR
- 18 – 100 percent when Vernalis monthly flow > 16,000 cfs

19 The frequency of the Rio Vista 3-day flow average > 90,000 cfs equals 50 percent
 20 when Freeport plus Yolo Bypass monthly flow is 67,820 cfs and the frequency of
 21 Vernalis 3-day flow average > 10,000 cfs equals 50 percent Vernalis monthly
 22 flow is 10,988 cfs. Therefore these two flow values are used as thresholds in the
 23 model.

24 **Off-ramps:** Only temperature-based off-ramping is considered. A surrogate
 25 biological off-ramp indicator was not included.

26 Temperature: Because the water temperature data at the three temperature stations
 27 (Antioch, Mossdale, and Rio Vista) are only available for years after 1984,
 28 another parameter was sought for use as an alternative indicator. It is observed
 29 that monthly average air temperature at Sacramento Executive Airport generally
 30 trends with the three-station average water temperature (Figure 5A.B.2). Using
 31 this alternative indicator, monthly average air temperature is assumed to occur in
 32 the middle of the month, and values are interpolated on a daily basis to obtain
 33 daily average water temperature. Using the correlation between air and water
 34 temperature, daily water temperatures are estimated from the 82-year monthly
 35 average air temperature. Dates when the three-station average temperature
 36 reaches 12°C are recorded and used as input in CalSim II. A 1:1 correlation was
 37 used for simplicity instead of using the trend line equation illustrated on
 38 Figure 5A.B.2.

39 **Rationale:** The following is an overall summary of the rationale for the preceding
 40 interpretation of RPA Action 2.

1 Action 2 requirements are based on X2 location that is dependent on the Delta
2 outflow. If outflows are very high, fewer Delta Smelt will spawn east of Sherman
3 Lake; therefore, the need for OMR restrictions is lessened.

4 In the case of Action 1 not being triggered, CDFW suggested OMR > -5,000 cfs,
5 following the actual implementation of the BO in winter 2009 because some adult
6 Delta Smelt might move into the Central Delta without a turbidity event.

7 Action 2 is suspended when the likelihood of a 3-day flow average greater than or
8 equal to 90,000 cfs in Sacramento River at Rio Vista and a 3-day flow average
9 greater than or equal to 10,000 cfs in San Joaquin River at Vernalis occurring
10 concurrently within the month exceeds 50 percent, because at extreme high flows
11 the majority of adult Delta Smelt will be distributed downstream of the Delta and
12 entrainment concerns will be very low.

13 The 12°C threshold for the off-ramp criterion is a conservative estimate of when
14 Delta Smelt larvae begin successfully hatching. Once hatched, the larvae move
15 into the water column where they are potentially vulnerable to entrainment.

16 **Results:** Using these assumptions, in a typical CalSim II 82-year simulation
17 (1922 through 2003 hydrologic conditions), Action 1, and therefore Action 2,
18 does not occur in 12 of the 82 years (1924, 1929, 1931, 1934, 1955, 1964, 1976,
19 1977, 1985, 1991, 1994, and 2001), typically critically dry years. The criteria for
20 suspension of OMR minimum flow requirements, described above, results in
21 potential suspension of Action 2 (if Action 2 is active) six times in January,
22 11 times in February, six times in March (however, Action 2 was not active three
23 of these six times), and two times in April. The result is that Action 2 is in effect
24 37 times in January (with OMR at -3,500 cfs 29 times, and at -5,000 cfs 8 times),
25 43 times in February (with OMR at -3,500 cfs 25 times, and at -5,000 cfs
26 18 times), 31 times in March (with OMR at -3,500 cfs 14 times, and at -5,000 cfs
27 17 times), and 80 times in April (with OMR at -3,500 cfs 46 times, and
28 at -5,000 cfs 34 times). The frequency each month is a cumulative result of the
29 action being triggered in the current or prior months. Refer to CalSim II
30 modeling results for more details on simulated operations of OMR, Delta exports,
31 and other parameters of interest.

32 **5A.B8.1.3 Action 3: Entrainment Protection of Larval and Juvenile Delta** 33 **Smelt (RPA Component 2)**

34 **5A.B8.1.3.1 Action 3 Summary:**

35 **Objective:** Minimize the number of larval Delta Smelt entrained at the facilities
36 by managing the hydrodynamics in the Central Delta flow levels pumping rates
37 spanning a time sufficient for protection of larval Delta Smelt, e.g., by using a
38 VAMP-like action. Because protective OMR flow requirements vary over time
39 (especially between years), the action is adaptive and flexible within appropriate
40 constraints.

41 **Action:** Net daily OMR flow will be no more negative than -1,250 to -5,000 cfs
42 based on a 14-day running average with a simultaneous 5-day running average

1 within 25 percent of the applicable requirement for OMR. Depending on extant
 2 conditions (and the general guidelines below), specific OMR flows within this
 3 range are recommended by the SWG from the onset of Action 3 through its
 4 termination (see Adaptive Process in Introduction). The SWG would provide
 5 these recommendations based upon weekly review of sampling data, from real-
 6 time salvage data at the CVP and SWP, and expertise and knowledge relating
 7 population status and predicted distribution to monitored physical variables of
 8 flow and turbidity. The USFWS will make the final determination.

9 **Timing:** Initiate the action after reaching the triggers below, which are indicative
 10 of spawning activity and the probable presence of larval Delta Smelt in the South
 11 and Central Delta. Based upon daily salvage data, the SWG may recommend an
 12 earlier start to Action 3. The USFWS will make the final determination.

13 **Triggers:**

14 Temperature: When temperature reaches 12°C based on a three-station average at
 15 the temperature stations: Mossdale, Antioch, and Rio Vista.

16 OR

17 Biological: Onset of spawning (presence of spent females in SKT or at either
 18 facility).

19 **Off-ramps:**

20 Temporal: June 30;

21 OR

22 Temperature: Water temperature reaches a daily average of 25°C for three
 23 consecutive days at Clifton Court Forebay.

24 **5A.B8.1.4 Action 3 Assumptions for CalSim II Modeling Purposes:**

25 An approach was selected based on assumed temperature and X2 salinity
 26 conditions. This approach selects from among three OMR flow tiers depending
 27 on the previous month's X2 position and ranges from an OMR criteria of -1,250
 28 to -5,000 cfs. Because of the potential low export conditions that could occur at
 29 an OMR criterion of -1,250 cfs, a criterion for minimum exports for health and
 30 safety is also assumed. The assumptions used for modeling are as follows:

31 **Action:** Limit exports so that the average daily OMR flow is no more negative
 32 than -1,250, -3,500, or -5,000 cfs, depending on the previous month's ending X2
 33 location (-1,250 cfs if X2 is east of Chipps Island, -5,000 cfs if X2 is west of Roe
 34 Island, or -3,500 cfs if X2 is between Chipps and Roe Island, inclusively), with a
 35 5-day running average within 25 percent of the monthly criteria (no more negative
 36 than -1,562 cfs if X2 is east of Chipps Island, -6,250 cfs if X2 is west of Roe
 37 Island, or -4,375 cfs if X2 is between Chipps and Roe Island). The more
 38 constraining of this OMR requirement or the VAMP requirement will be selected
 39 during the VAMP period (April 15 to May 15). Additionally, in the case of the
 40 month of June, the OMR criterion from May is maintained through June (it is
 41 assumed that June OMR should not be more constraining than May).

1 **Timing:** Begins immediately upon temperature trigger conditions and continues
2 until off-ramp conditions are met.

3 **Triggers:** Only temperature trigger conditions are considered. A surrogate
4 biological trigger was included.

5 Temperature: Because the water temperature data at the three temperature stations
6 (Antioch, Mossdale, and Rio Vista) are only available for years after 1984,
7 another parameter was sought to be used as an alternative indicator. It is observed
8 that monthly average air temperature at Sacramento Executive Airport generally
9 trends with the three-station average water temperature (Figure 5A.B.2). Using
10 this alternative indicator, monthly average air temperature is assumed to occur in
11 the middle of the month, and values are interpolated on a daily basis to obtain
12 daily average water temperature. Using the correlation between air and water
13 temperature, estimated daily water temperatures are estimated from the 82-year
14 monthly average air temperature. Dates when the three-station average
15 temperature reaches 12°C are recorded and used as input in CalSim II. A 1:1
16 correlation was used for simplicity instead of using the trend line equation
17 illustrated on Figure 5A.B.2.

18 Biological: Onset of spawning is assumed to occur no later than May 30.

19 *Clarification Note: This text previously read “Onset of spawning is assumed to*
20 *occur no later than April 30”, where the CalSim II lookup table has May 30 as*
21 *the date. Based on RPA team discussions in August 2009, it was agreed upon that*
22 *onset of spawning could not be modeled in CalSim II. This trigger was actually*
23 *coded as a placeholder in case in the future this trigger was to be used; the date*
24 *was selected purposefully in a way that it wouldn’t affect modeling results.*
25 *Temperature trigger for Action 3 does occur before end of April. Therefore it*
26 *does not matter whether the document is corrected to read May 30 or the model*
27 *lookup table is changed to April 30.*

28 **Off-ramps:**

29 Temporal: It is assumed that the ending date of the action would be no later than
30 June 30.

31 OR

32 Temperature: Only 17 years of data are available for Clifton Court water
33 temperature. A similar approach as used in the temperature trigger was
34 considered. However, because 3 consecutive days of water temperature greater
35 than or equal to 25°C is required, a correlation between air temperature and water
36 temperature did not work well for this off-ramp criterion. Out of the 17 recorded
37 years, in 1 year the criterion was triggered in May (May 31), and in 3 years it was
38 triggered in June (June 3, 21, and 27). In all other years it was observed in July or
39 later. With only four data points before July, it was not possible to generate a rule
40 based on statistics. Therefore, temporal off-ramp criterion (June 30) is used for
41 all years.

42 **Health and Safety:** In CalSim II, a minimum monthly Delta export criterion of
43 300 cfs for SWP and 600 cfs (or 800 cfs depending on Shasta storage) for CVP is

1 assumed. This assumption is suitable for dry-year conditions when allocations are
2 low and storage releases are limited; however, minimum monthly exports need to
3 be made for protection of public health and safety (health and safety deliveries
4 upstream of San Luis Reservoir).

5 In consideration of the severe export restrictions associated with the OMR criteria
6 established in the RPAs, an additional set of health and safety criterion is
7 assumed. These export restrictions could lead to a situation in which supplies are
8 available and allocated; however, exports are curtailed forcing San Luis to have
9 an accelerated drawdown rate. For dam safety at San Luis Reservoir, 2 feet per
10 day is the maximum acceptable drawdown rate. Drawdown occurs faster in
11 summer months and peaks in June when the agricultural demands increase. To
12 avoid rapid drawdown in San Luis Reservoir, a relaxation of OMR is allowed so
13 that exports can be maintained at 1,500 cfs in all months if needed.

14 This modeling approach may not fit the real-life circumstances. In summer
15 months, especially in June, the assumed 1,500 cfs for health and safety may not
16 be sufficient to keep San Luis drawdown below a safe 2 feet per day; under such
17 circumstances the projects would be required to increase pumping in order to
18 maintain dam safety.

19 **Rationale:** The following is an overall summary of the rationale for the preceding
20 interpretation of RPA Action 3.

21 The geographic distribution of larval and juvenile Delta Smelt is tightly linked to
22 X2 (or Delta outflow). Therefore, the percentage of the population likely to be
23 found east of Sherman Lake is also influenced by the location of X2. The X2-
24 based OMR criteria were intended to model an expected management response to
25 the general increase in Delta Smelt's risk of entrainment as a function of
26 increasing X2.

27 The 12°C threshold for the trigger criterion is a conservative estimate of when
28 Delta Smelt larvae begin successfully hatching. Once hatched, the larvae move
29 into the water column where they are potentially vulnerable to entrainment.

30 The annual salvage season for Delta Smelt typically ends as South Delta water
31 temperatures warm to lethal levels during summer. This usually occurs in late
32 June or early July. The laboratory-derived upper lethal temperature for Delta
33 Smelt is 25.4°C.

34 **Results:** Action 3 occurs 30 times in February (with OMR at -1,250 cfs 9 times,
35 at -3,500 cfs 11 times, and at -5,000 cfs 10 times), 76 times in March (with OMR
36 at -1,250 cfs 15 times, at -3,500 cfs 27 times, and at -5,000 cfs 34 times), all times
37 (82) in April (with OMR at -1,250 cfs 17 times, at -3,500 cfs 29 times, and at -
38 5,000 cfs 35 times), all times (82) in May (with OMR at -1,250 cfs 19 times, at -
39 3,500 cfs 37 times, and at -5,000 cfs 26 times), and 70 times in June (with OMR
40 at -1,250 cfs 7 times, at -3,500 cfs 37 times, and at -5,000 cfs 26 times). Refer to
41 CalSim II modeling results for more details on simulated operations of OMR,
42 Delta exports and other parameters of interest. (Note: The above information is

1 based on the August 2009 version of the model and documents the development
 2 process; more recent versions of the model may have different results.)

3 **5A.B8.1.5 Action 4: Estuarine Habitat During Fall (RPA Component 3)**

4 **5A.B8.1.5.1 Action 4 Summary:**

5 **Objective:** Improve fall habitat for Delta Smelt by managing of X2 through
 6 increasing Delta outflow during fall when the preceding water year was wetter
 7 than normal. This will help return ecological conditions of the estuary to that
 8 which occurred in the late 1990s when smelt populations were much larger.
 9 Flows provided by this action are expected to provide direct and indirect benefits
 10 to Delta Smelt. Both the direct and indirect benefits to Delta Smelt are considered
 11 equally important to minimize adverse effects.

12 **Action:** Subject to adaptive management as described below, provide sufficient
 13 Delta outflow to maintain average X2 for September and October no greater
 14 (more eastward) than 74 kilometers in the fall following Wet years and
 15 81 kilometers in the fall following Above Normal years. The monthly average
 16 X2 position is to be maintained at or seaward of these location for each individual
 17 month and not averaged over the 2-month period. In November, the inflow to
 18 CVP and SWP reservoirs in the Sacramento Basin will be added to reservoir
 19 releases to provide an added increment of Delta inflow and to augment Delta
 20 outflow up to the fall X2 target. The action will be evaluated and may be
 21 modified or terminated as determined by the USFWS.

22 **Timing:** September 1 to November 30.

23 **Triggers:** Wet and Above Normal water-year type classification from the 1995
 24 Water Quality Control Plan that is used to implement D-1641.

25 **5A.B8.1.5.2 Action 4 Assumptions for CalSim II Modeling Purposes:**

26 Model is modified to increase Delta outflow to meet monthly average X2
 27 requirements for September and October and subsequent November reservoir
 28 release actions in Wet and Above Normal years. No off-ramps are considered for
 29 reservoir release capacity constraints. Delta exports may or may not be reduced
 30 as part of reservoir operations to meet this action. The action is summarized in
 31 Table 5A.B.29.

32 **Table 5A.B.29 Summary of Action 4 implementation in CalSim II**

Fall Months following Wet or Above Normal Years	Action Implementation
September	Meet monthly average X2 requirement (74 km in Wet years, 81 km in Above Normal years)
October	Meet monthly average X2 requirement (74 km in Wet years, 81 km in Above Normal years)
November	Add reservoir releases up to natural inflow as needed to continue to meet monthly average X2 requirement (74 km in Wet years, 81 km in Above Normal years)

1 **Rationale:** Action 4 requirements are based on determining X2 location.
2 Adjustment and retraining of the ANN was also completed to address numerical
3 sensitivity concerns.

4 **Results:** There are 38 September and 37 October months that the action is
5 triggered over the 82-year simulation period.

6 **5A.B8.1.6 Action 5: Temporary Spring Head of Old River Barrier and the**
7 **Temporary Barrier Project (RPA Component 2)**

8 **5A.B8.1.6.1 Action 5 Summary:**

9 Objective: To minimize entrainment of larval and juvenile Delta Smelt at Banks
10 and Jones or from being transported into the South and Central Delta, where they
11 could later become entrained.

12 **Action:** Do not install the spring HORB if Delta Smelt entrainment is a concern.
13 If installation of the HORB is not allowed, the agricultural barriers would be
14 installed as described in the project description. If installation of the HORB is
15 allowed, the Temporary Barrier Project (TBP) flap gates would be tied in the open
16 position until May 15.

17 **Timing:** The timing of the action would vary depending on the conditions. The
18 normal installation of the spring temporary HORB and the TBP is in April.

19 **Triggers:** For Delta Smelt, installation of the HORB will only occur when
20 particle tracking modeling results show that entrainment levels of Delta Smelt
21 will not increase beyond 1 percent at Station 815 as a result of installing the
22 HORB.

23 **Off-ramps:** If Action 3 ends or May 15, whichever comes first.

24 **5A.B8.1.6.2 Action 5 Assumptions for CalSim II and DSM2 Modeling**
25 **Purposes:**

26 The South Delta Improvement Program Stage 1 is not included in the Existing
27 and Future Condition assumptions being used for CalSim II and DSM2 baselines.
28 The TBP is assumed instead. The TBP specifies that HORB be installed and
29 operated during April 1 through May 31 and September 16 through November 30.
30 In response to the USFWS BO, Action 5, the HORB is assumed to not be
31 installed during April 1 through May 31.

32 **5A.B9 NMFS RPA Implementation**

33 The information included in this section is consistent with what was provided to
34 and agreed by the lead agencies in the, “Representation of U.S. Fish and Wildlife
35 Service Biological Opinion Reasonable and Prudent Alternative Actions for
36 CalSim II Planning Studies”, on February 10, 2010 (updated May 18, 2010).

**5A.B9.1 Representation of National Marine Fisheries Service
Biological Opinion Reasonable and Prudent Alternative
Actions for CalSim II Planning Studies**

The NMFS BO was released on June 4, 2009. To develop CalSim II modeling assumptions to represent the operations related RPA actions required by this BO, DWR led a series of meetings that involved members of fisheries and project agencies. The purpose for establishing this group was to prepare the assumptions and CalSim II implementations to represent the RPAs in both Existing- and Future-Condition CalSim II simulations for future planning studies.

This memorandum summarizes the approach that resulted from these meetings and the modeling assumptions that were laid out by the group. The scope of this memorandum is limited to the June 4, 2009 BO. All descriptive information of the RPAs is taken from the BO.

Table 5A.B.30 lists the participants that contributed to the meetings and information summarized in this document.

Table 5A.B.30 Meeting Participants

Aaron Miller/DWR Randi Field/Reclamation Lenny Grimaldo/Reclamation Henry Wong/Reclamation	Derek Hilts/USFWS Roger Guinee/ USFWS Matt Nobriga/CDFW Bruce Oppenheim/ NMFS
Parviz Nader-Tehrani/ DWR Erik Reyes/ DWR Sean Sou/ DWR Paul A. Marshall/ DWR Ming-Yen Tu/ DWR Xiaochun Wang/ DWR	Robert Leaf/CH2M HILL Derya Sumer/CH2M HILL

The RPA actions in NMFS’s BO are based on physical and biological processes that do not lend themselves to simulations using a monthly time step. Much scientific and modeling judgment has been employed to represent the implementation of the RPAs. The group believes the logic put into CalSim II represents the RPAs as best as possible at this time, given the scientific understanding of environmental factors enumerated in the BO and the limited historical data for some of these factors.

Given the relatively generalized representation of the RPAs assumed for CalSim II modeling, much caution is required when interpreting outputs from the model.

5A.B9.1.1 Action Suite 1.1 Clear Creek

Suite Objective: The RPA actions described below were developed based on a careful review of past flow studies, current operations, and future climate change scenarios. These actions are necessary to address adverse project effects on flow and water temperature that reduce the viability of spring-run and Central Valley Steelhead in Clear Creek.

1 **5A.B9.1.1.1 Action 1.1.1 Spring Attraction Flows**

2 **Objective:** Encourage spring-run movement to upstream Clear Creek habitat for
3 spawning.

4 **Action:** Reclamation shall annually conduct at least two pulse flows in Clear
5 Creek in May and June of at least 600 cfs for at least 3 days for each pulse, to
6 attract adult spring-run holding in the Sacramento River main stem.

7 *Action 1.1.1 Assumptions for CalSim II Modeling Purposes*

8 **Action:** Model is modified to meet 600 cfs for 3 days twice in May. In the
9 CalSim II analysis, flows sufficient to increase flow up to 600 cfs for a total of
10 6 days are added to the flows that would have otherwise occurred in Clear Creek.

11 **Rationale:** CalSim II is a monthly model. The monthly flow in Clear Creek is an
12 underestimate of the actual flows that would occur subject to daily operational
13 constraints at Whiskeytown Reservoir. The additional flow to meet 600 cfs for a
14 total of 6 days was added to the monthly average flow model.

15 **5A.B9.1.1.2 Action 1.1.5 Thermal Stress Reduction**

16 **Objective:** To reduce thermal stress to over-summering steelhead and spring-run
17 during holding, spawning, and embryo incubation.

18 **Action:** Reclamation shall manage Whiskeytown releases to meet a daily water
19 temperature of: (1) 60°F at the Igo gauge from June 1 through September 15 and
20 (2) 56°F at the Igo gauge from September 15 to October 31.

21 **5A.B9.1.1.3 Action 1.1.5 Assumptions for CalSim II Modeling Purposes**

22 **Action:** It is assumed that temperature operations can perform reasonably well
23 with flows included in model.

24 **Rationale:** A temperature model of Whiskeytown Reservoir has been developed
25 by Reclamation. Further analysis using this or other temperature model is
26 required to verify the statement that temperature operations can perform
27 reasonably well with flows included in model.

28 **5A.B9.1.2 Action Suite 1.2 Shasta Operations**

29 **Objectives:** To address the avoidable and unavoidable adverse effects of Shasta
30 operations on winter-run and spring-run:

- 31 • Ensure a sufficient cold water pool to provide suitable temperatures for
32 winter-run spawning between Balls Ferry and Bend Bridge in most years,
33 without sacrificing the potential for cold water management in a subsequent
34 year. Additional actions to those in the 2004 CVP and SWP operations
35 opinion are needed, due to increased vulnerability of the population to
36 temperature effects attributable to changes in Trinity River ROD operations,
37 projected climate change hydrology, and increased water demands in the
38 Sacramento River system.
- 39 • Ensure suitable spring-run temperature regimes, especially in September and
40 October. Suitable spring-run temperatures will also partially minimize

- 1 temperature effects to naturally spawning, non-listed Sacramento River fall-
2 run, an important prey base for endangered Southern Residents.
- 3 • Establish a second population of winter-run in Battle Creek as soon as
4 possible, to partially compensate for unavoidable project-related effects on the
5 one remaining population.
 - 6 • Restore passage at Shasta Reservoir with experimental reintroductions of
7 winter-run to the upper Sacramento and/or McCloud rivers, to partially
8 compensate for unavoidable project related effects on the remaining
9 population.

10 **5A.B9.1.2.1 Action 1.2.1 Performance Measures**

11 **Objective:** To establish and operate to a set of performance measures for
12 temperature compliance points and End-of-September (EOS) carryover storage,
13 enabling Reclamation and NMFS to assess the effectiveness of this suite of
14 actions over time. Performance measures will help to ensure that the beneficial
15 variability of the system from changes in hydrology will be measured and
16 maintained.

17 **Action:** To ensure a sufficient cold water pool to provide suitable temperatures,
18 long-term performance measures for temperature compliance points and EOS
19 carryover storage at Shasta Reservoir shall be attained. Performance measures for
20 EOS carryover storage at Shasta Reservoir are as follows:

- 21 • 87 percent of years: Minimum EOS storage of 2.2 MAF
- 22 • 82 percent of years: Minimum EOS storage of 2.2 MAF and end-of-April
23 storage of 3.8 MAF in following year (to maintain potential to meet Balls
24 Ferry compliance point)
- 25 • 40 percent of years: Minimum EOS storage 3.2 MAF (to maintain potential to
26 meet Jelly’s Ferry compliance point in following year)

27 Performance measures (measured as a 10-year running average) for temperature
28 compliance points during summer season are:

- 29 • Meet Clear Creek Compliance point 95 percent of time
- 30 • Meet Balls Ferry Compliance point 85 percent of time
- 31 • Meet Jelly’s Ferry Compliance point 40 percent of time
- 32 • Meet Bend Bridge Compliance point 15 percent of time

33 **5A.B9.1.2.2 Action 1.2.1 Assumptions for CalSim II Modeling Purposes**

34 **Action:** No specific CalSim II modeling code is implemented to simulate the
35 performance measures identified. System performance will be assessed and
36 evaluated through post-processing of various model results.

37 **Rationale:** Given that the performance criteria are based on the CalSim II
38 modeling data used in preparation of the Biological Assessment, the system
39 performance after application of the RPAs should be similar as a percentage of

1 years that the end-of-April storage and temperature compliance requirements are
 2 met over the simulation period. Post-processing of modeling results will be
 3 compared to various new operating scenarios as needed to evaluate performance
 4 criteria and appropriateness of the rules developed.

5 **5A.B9.1.2.3 Action 1.2.2 November through February Keswick Release**
 6 **Schedule (Fall Actions)**

7 **Objective:** Minimize impacts to listed species and naturally spawning non-listed
 8 fall-run from high water temperatures by implementing standard procedures for
 9 release of cold water from Shasta Reservoir.

10 **Action:** Depending on EOS carryover storage and hydrology, Reclamation shall
 11 develop and implement a Keswick release schedule, and reduce deliveries and
 12 exports as needed to achieve performance measures.

13 *Action 1.2.2 Assumptions for CalSim II Modeling Purposes*

14 **Action:** No specific CalSim II modeling code is implemented to simulate the
 15 performance measures identified. Keswick flows based on operation of
 16 3406(b)(2) releases in OCAP Study 7.1 (for Existing) and Study 8 (for Future) are
 17 used in CalSim II. These flows will be reviewed for appropriateness under this
 18 action. A post-process based evaluation similar to what has been explained in
 19 Action 1.2.1 will be conducted.

20 **Rationale:** Performance measures are set as percentage of years that the end-of-
 21 September and temperature compliance requirements are met over the simulation
 22 period. Post-processing of modeling results will be compared to various new
 23 operating scenarios as needed to evaluate performance criteria and
 24 appropriateness of the rules developed.

25 **5A.B9.1.2.4 Action 1.2.3 February Forecast; March – May 14 Keswick**
 26 **Release Schedule (Spring Actions)**

27 **Objective:** To conserve water in Shasta Reservoir in the spring in order to
 28 provide sufficient water to reduce adverse effects of high water temperature in the
 29 summer months for winter-run, without sacrificing carryover storage in the fall.

30 **Action:**

- 31 • Reclamation shall make its February forecast of deliverable water based on an
 32 estimate of precipitation and runoff within the Sacramento River basin at least
 33 as conservative as the 90 percent probability of exceedance. Subsequent
 34 updates of water delivery commitments must be based on monthly forecasts at
 35 least as conservative as the 90 percent probability of exceedance.
- 36 • Reclamation shall make releases to maintain a temperature compliance point
 37 not in excess of 56°F between Balls Ferry and Bend Bridge from April 15
 38 through May 15.

1 *Action 1.2.3 Assumptions for CalSim II Modeling Purposes*

2 **Action:** No specific CalSim II modeling code is implemented to simulate the
3 performance measures identified. It is assumed that temperature operations can
4 perform reasonably well with flows included in model.

5 **Rationale:** Temperature models of Shasta Lake and the Sacramento River have
6 been developed by Reclamation. This modeling reflects current facilities for
7 temperature controlled releases. Further analysis using this or another
8 temperature model can further verify that temperature operations can perform
9 reasonably well with flows included in model and temperatures are met reliably at
10 each of the compliance points. In the future, it may be that adjusted flow
11 schedules may need to be developed based on development of temperature model
12 runs in conjunction with CalSim II modeled operations.

13 **5A.B9.1.2.5 Action 1.2.4 May 15 through October Keswick Release**
14 **Schedule (Summer Action)**

15 Objective: To manage the cold water storage within Shasta Reservoir and make
16 cold water releases from Shasta Reservoir to provide suitable habitat temperatures
17 for winter-run, spring-run, Central Valley Steelhead, and Southern Distinct
18 Population Segment (DPS) of Green Sturgeon in the Sacramento River between
19 Keswick Dam and Bend Bridge, while retaining sufficient carryover storage to
20 manage for next year's cohorts. To the extent feasible, manage for suitable
21 temperatures for naturally spawning fall-run.

22 **Action:** Reclamation shall manage operations to achieve daily average water
23 temperatures in the Sacramento River between Keswick Dam and Bend Bridge as
24 follows:

- 25 • Not in excess of 56°F at compliance locations between Balls Ferry and Bend
26 Bridge from May 15 through September 30 for protection of winter-run, and
27 not in excess of 56°F at the same compliance locations between Balls Ferry
28 and Bend Bridge from October 1 through October 31 for protection of
29 mainstem spring run, whenever possible.
- 30 • Reclamation shall operate to a final Temperature Management Plan starting
31 May 15 and ending October 31.

32 *Action 1.2.4 Assumptions for CalSim II Modeling Purposes*

33 **Action:** No specific CalSim II modeling code is implemented to simulate the
34 performance measures identified. It is assumed that temperature operations can
35 perform reasonably well with flows included in model. During the detailed
36 effects analysis, temperature modeling and post-processing will be used to verify
37 temperatures are met at the compliance points. In the long-term approach, for a
38 complete interpretation of the action, development of temperature model runs are
39 needed to develop flow schedules if needed for implementation into CalSim II.

40 **Rationale:** Temperature models of Shasta Lake and the Sacramento River have
41 been developed by Reclamation. This modeling reflects current facilities for
42 temperature controlled releases. Further analysis using this or another

1 temperature model is required to verify the statement that temperature operations
 2 can perform reasonably well with flows included in model and temperatures are
 3 met reliably at each of the compliance points. Alternative flow schedules may
 4 need to be developed based on development of temperature model runs in
 5 conjunction with CalSim II modeled operations.

6 **5A.B9.1.3 Action Suite 1.3 Red Bluff Diversion Dam (RBDD) Operations**

7 **Objectives:** Reduce mortality and delay of adult and juvenile migration of winter-
 8 run, spring-run, Central Valley Steelhead, and Southern DPS of Green Sturgeon
 9 caused by the presence of the diversion dam and the configuration of the operable
 10 gates. Reduce adverse modification of the passage element of critical habitat for
 11 these species. Provide unimpeded upstream and downstream fish passage in the
 12 long-term by raising the gates year-round, and minimize adverse effects of
 13 continuing dam operations, while pumps are constructed to replace the loss of the
 14 diversion structure.

15 **5A.B9.1.3.1 Action 1.3.1 Operations after May 14, 2012: Operate RBDD**
 16 **with Gates Out**

17 **Action:** No later than May 15, 2012, Reclamation shall operate RBDD with gates
 18 out all year to allow unimpeded passage for listed anadromous fish.

19 *Action 1.3.1 Assumptions for CalSim II Modeling Purposes*

20 **Action:** Adequate permanent facilities for diversion are assumed; therefore, no
 21 constraint on diversion schedules is included in the Future condition modeling.

22 **5A.B9.1.3.2 Action 1.3.2 Interim Operations**

23 **Action:** Until May 14, 2012, Reclamation shall operate RBDD according to the
 24 following schedule:

- 25 • September 1—June 14: Gates open. No emergency closures of gates are
 26 allowed.
- 27 • June 15—August 31: Gates may be closed at Reclamation’s discretion, if
 28 necessary to deliver water to TCCA.

29 *Action 1.3.2 Assumptions for CalSim II Modeling Purposes*

30 **Action:** Adequate interim/temporary facilities for diversion are assumed;
 31 therefore, no constraint on diversion schedules is included in the No Action
 32 Alternative modeling.

33 **5A.B9.1.4 Action 1.4 Wilkins Slough Operations**

34 **Objective:** Enhance the ability to manage temperatures for anadromous fish
 35 below Shasta Dam by operating Wilkins Slough in the manner that best conserves
 36 the dam’s cold water pool for summer releases.

37 **Action:** The Sacramento River Temperature Task Group (SRTTG) shall make
 38 recommendations for Wilkins Slough minimum flows for anadromous fish in
 39 critically dry years, in lieu of the current 5,000 cfs navigation criterion to NMFS

1 by December 1, 2009. In critically dry years, the SRTTG will make a
 2 recommendation.

3 **5A.B9.1.4.1 Action 1.4 Assumptions for CalSim II Modeling Purposes**

4 **Action:** Current rules for relaxation of NCP in CalSim II (based on BA models)
 5 will be used. In CalSim II, NCP flows are relaxed depending on allocations for
 6 agricultural contractors. Table 5A.B.31 is used to determine the relaxation.

7 **Table 5A.B.31 NCP Flow Schedule with Relaxation**

CVP AG Allocation (percent)	NCP Flow (cfs)
< 10	3,250
10–25	3,500
25–40	4,000
40–65	4,500
> 65	5,000

8 **Rationale:** The allocation-flow criteria have been used in the CalSim II model for
 9 many years. The low allocation year relaxations were added to improve
 10 operations of Shasta Lake subject to 1.9 MAF carryover target storage. These
 11 criteria may be reevaluated subject to the requirements of Action 1.2.1.

12 **5A.B9.1.5 Action 2.1 Lower American River Flow Management**

13 **Objective:** To provide minimum flows for all steelhead life stages.

14 **Action:** Implement the flow schedule specified in the Water Forum’s Flow
 15 Management Standard (FMS), which is summarized in Appendix 2-D of the
 16 NMFS BO.

17 **5A.B9.1.5.1 Action 2.1 Assumptions for CalSim II Modeling Purposes**

18 **Action:** The AFRMP Minimum Release Requirements (MRR) range from 800 to
 19 2,000 cfs based on a sequence of seasonal indices and adjustments. The
 20 minimum Nimbus Dam release requirement is determined by applying the
 21 appropriate water availability index (Index Flow). Three water availability
 22 indices (i.e., Four Reservoir Index (FRI), Sacramento River Index (SRI), and the
 23 Impaired Folsom Inflow Index (IFII)) are applied during different times of the
 24 year, which provides adaptive flexibility in response to changing hydrological and
 25 operational conditions.

26 During some months, Prescriptive Adjustments may be applied to the Index Flow,
 27 resulting in the MRR. If there is no Prescriptive Adjustment, the MRR is equal to
 28 the Index Flow.

29 Discretionary Adjustments for water conservation or fish protection may be
 30 applied during the period extending from June through October. If Discretionary
 31 Adjustments are applied, then the resultant flows are referred to as the Adjusted
 32 Minimum Release Requirement (Adjusted MRR).

1 The MRR and Adjusted MRR may be suspended in the event of extremely dry
 2 conditions, represented by “conference years” or “off-ramp criteria”. Conference
 3 years are defined when the projected March through November unimpaired
 4 inflow into Folsom Reservoir is less than 400,000 acre-feet. Off-ramp criteria are
 5 triggered if forecasted Folsom Reservoir storage at any time during the next
 6 12 months is less than 200,000 acre-feet.

7 **Rationale:** Minimum instream flow schedule specified in the Water Forum’s
 8 FMS is implemented in the model.

9 **5A.B9.1.6 Action 2.2 Lower American River Temperature Management**

10 **Objective:** Maintain suitable temperatures to support over-summer rearing of
 11 juvenile steelhead in the lower American River.

12 **Action:** Reclamation shall develop a temperature management plan that contains:
 13 (1) forecasts of hydrology and storage; (2) a modeling run or runs, using these
 14 forecasts, demonstrating that the temperature compliance point can be attained
 15 (see Coldwater Management Pool Model approach in Appendix 2-D); (3) a plan
 16 of operation based on this modeling run that demonstrates that all other non-
 17 discretionary requirements are met; and (4) allocations for discretionary deliveries
 18 that conform to the plan of operation.

19 **5A.B9.1.6.1 Action 2.2 Assumptions for CalSim II Modeling Purposes**

20 **Action:** The flows in the model reflect the FMS implemented under Action 2.1.
 21 It is assumed that temperature operations can perform reasonably well with flows
 22 included in model.

23 **Rationale:** Temperature models of Folsom Lake and the American River were
 24 developed in the 1990s. Model development for long-range planning purposes
 25 may be required. Further analysis using a verified long-range planning level
 26 temperature model is required to verify the statement that temperature operations
 27 can perform reasonably well with flows included in the model and when
 28 temperatures are met reliably

29 **5A.B9.1.7 Action Suite 3.1 Stanislaus River/Eastside Division Actions**

30 **Overall Objectives:** (1) Provide sufficient definition of operational criteria for
 31 Eastside Division to ensure viability of the steelhead population on the Stanislaus
 32 River, including freshwater migration routes to and from the Delta; and (2) halt or
 33 reverse adverse modification of steelhead critical habitat.

34 **5A.B9.1.7.1 Action 3.1.2 Provide Cold Water Releases to Maintain Suitable**
 35 **Steelhead Temperatures**

36 **Action:** Reclamation shall manage the cold water supply within New Melones
 37 Reservoir and make cold water releases from New Melones Reservoir to provide
 38 suitable temperatures for CV steelhead rearing, spawning, egg incubation
 39 smoltification, and adult migration in the Stanislaus River downstream of
 40 Goodwin Dam.

1 *Action 3.1.2 Assumptions for CalSim II Modeling Purposes*

2 **Action:** No specific CalSim II modeling code is implemented to simulate the
3 performance measures identified. It is assumed that temperature operations can
4 perform reasonably well with flow operations resulting from the minimum flow
5 requirements described in Action 3.1.3.

6 **Rationale:** Temperature models of New Melones Lake and the Stanislaus River
7 have been developed by Reclamation. Further analysis using this or another
8 temperature model can further verify that temperature operations perform
9 reasonably well with flows included in model and temperatures are met reliably.
10 Development of temperature model runs is needed to refine the flow schedules
11 assumed.


12 **5A.B9.1.7.2 Action 3.1.3 Operate the East Side Division Dams to Meet the**
13 **Minimum Flows, as Measured at Goodwin Dam**

14 **Objective:** To maintain minimum base flows to optimize Central Valley
15 Steelhead habitat for all life history stages and to incorporate habitat maintaining
16 geomorphic flows in a flow pattern that will provide migratory cues to smolts and
17 facilitate out-migrant smolt movement on declining limb of pulse.

18 **Action:** Reclamation shall operate releases from the East Side Division reservoirs
19 to achieve a minimum flow schedule as prescribed in NMFS BO Appendix 2-E.
20 When operating at higher flows than specified, Reclamation shall implement
21 ramping rates for flow changes that will avoid stranding and other adverse effects
22 on Central Valley Steelhead.

23 *Action 3.1.3 Assumptions for CalSim II Modeling Purposes*

24 **Action:** Minimum flows based on Appendix 2-E flows (presented in
25 Figure 5A.B.3) are assumed consistent to what was modeled by NMFS (May 14
26 and 15, 2009 CalSim II models provided by NMFS; relevant logic merged into
27 baselines models).

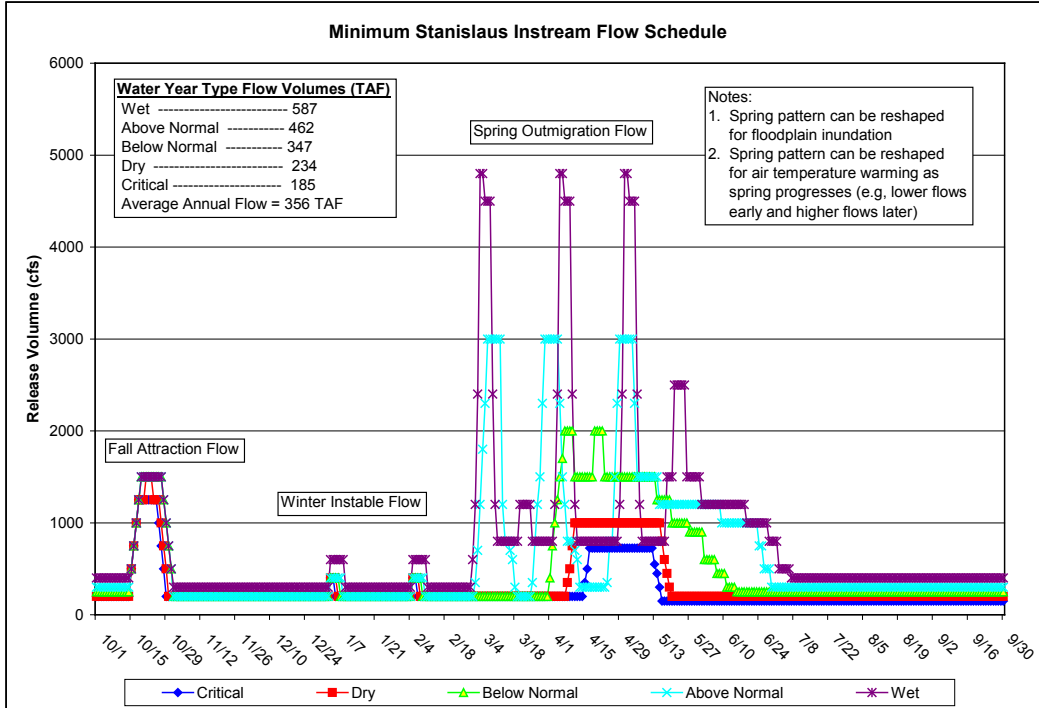

1 **Figure 5A.B.3 Minimum Stanislaus instream flow schedule as prescribed in**
 2 **Appendix 2-E of the NMFS BO (06/04/09)**

3 Annual allocation in New Melones is modeled to ensure availability of required
 4 instream flows (Table 5A.B.32) based on a water supply forecast that is
 5 comprised of end-of-February New Melones Storage (in TAF) plus forecasted
 6 inflow to New Melones from March 1 to September 30 (in TAF). The forecasted
 7 inflow is calculated using perfect foresight in the model. An allocated volume of
 8 water is released according to water year type following the monthly flow
 9 schedule illustrated in Figure 5A.B.3.

10 **Table 5A.B.32 New Melones Allocations to Meet Minimum Instream Flow**
 11 **Requirements**

New Melones index (TAF)	Annual Allocation Required for Instream Flows (TAF)
< 1000	0 to 98.9
1,000 to 1,399	98.9
1,400 to 1,724	185.3
1,725 to 2,177	234.1
2,178 to 2,386	346.7
2,387 to 2,761	461.7
2,762 to 6,000	586.9

1 **Rationale:** This approach was reviewed by National Oceanic and Atmospheric
 2 Administration (NOAA) fisheries and verified that the year typing and New
 3 Melones allocation scheme are consistent with the modeling prepared for the BO.

4 **5A.B9.1.8 Action Suite 4.1 Delta Cross Channel Gate Operation, and**
 5 **Engineering Studies of Methods to Reduce Loss of Salmonids in**
 6 **Georgiana Slough and Interior Delta**

7 **5A.B9.1.8.1 Action 4.1.2 DCC Gate Operation**

8 **Objective:** Modify DCC gate operation to reduce direct and indirect mortality of
 9 emigrating juvenile salmonids and Green Sturgeon in November, December, and
 10 January.

11 **Action:** During the period between November 1 and June 15, DCC gate
 12 operations will be modified from the proposed action to reduce loss of emigrating
 13 salmonids and Green Sturgeon. From December 1 to January 31, the gates will
 14 remain closed, except as operations are allowed using the implementation
 15 procedures/modified Salmon Decision Tree.

16 **Timing:** November 1 through June 15.

17 **Triggers:** Action triggers and description of action as defined in NMFS BO are
 18 presented in Table 5A.B.33.

19 **Table 5A.B.33 NMFS BO DCC Gate Operation Triggers and Actions**

Date	Action Triggers	Action Responses
October 1 – November 30	Water quality criteria per D-1641 are met and either the Knights Landing Catch Index (KLCI) or the Sacramento Catch Index (SCI) are greater than 3 fish per day, but less than or equal to 5 fish per day.	Within 24 hours of trigger, DCC gates are closed. Gates will remain closed for 3 days.
	Water quality criteria per D-1641 are met and either the KLCI or SCI is greater than 5 fish per day.	Within 24 hours, close the DCC gates and keep closed until the catch index is less than 3 fish per day at both the Knights Landing and Sacramento monitoring sites.
	The KLCI or SCI triggers are met, but water quality criteria are not met per D-1641 criteria.	DOSS reviews monitoring data and makes recommendation to NMFS and WOMT per procedures in Action IV.5.


Date	Action Triggers	Action Responses
December 1 – December 14	Water quality criteria are met per D-1641.	DCC gates are closed. If Chinook Salmon migration experiments are conducted during this time period (e.g., Delta Action 8 or similar studies), the DCC gates may be opened according to the experimental design, with NMFS' prior approval of the study.
	Water quality criteria are not met, but both the KLCI and SCI are less than 3 fish per day.	DCC gates may be opened until the water quality criteria are met. Once water quality criteria are met, the DCC gates will be closed within 24 hours of compliance.
	Water quality criteria are not met, but either the KLCI or SCI is greater than 3 fish per day.	DOSS reviews monitoring data and makes recommendation to NMFS and WOMT per procedures in Action IV.5
December 15 – January 31	December 15 – January 31	DCC Gates Closed.
	NMFS-approved experiments are being conducted.	Agency sponsoring the experiment may request gate opening for up to 5 days; NMFS will determine whether opening is consistent with ESA obligations.
	One-time event between December 15 and January 5, when necessary, to maintain Delta water quality in response to the astronomical high tide, coupled with low inflow conditions.	Upon concurrence of NMFS, DCC Gates may be opened 1 hour after sunrise to 1 hour before sunset, for up to 3 days, then return to full closure. Reclamation and DWR will also reduce Delta exports down to a health and safety level during the period of this action.
February 1 – May 15	D-1641 mandatory gate closure.	Gates closed, per WQCP criteria.
May 16 – June 15	D-1641 gate operations criteria	DCC gates may be closed for up to 14 days during this period, per 2006 WQCP, if NMFS determines it is necessary.

- 1 *Action 4.1.2 Assumptions for CalSim II Modeling Purposes*
- 2 **Action:** The DCC gate operations for October 1 through January 31 were layered
- 3 on top of the D-1641 gate operations already included in the CalSim II model.
- 4 The general assumptions regarding the NMFS DCC operations are summarized in
- 5 Table 5A.B.34.
- 6 **Timing:** October 1 through January 31.

1 **Table 5A.B.34 DCC Gate Operation Triggers and Actions as Modeled in CalSim II**

Date	Modeled Action Triggers	Modeled Action Responses
October 1 – December 14	Sacramento River daily flow at Wilkins Slough exceeding 7,500 cfs; flow assumed to flush salmon into the Delta	Each month, the DCC gates are closed for the number of days estimated to exceed the threshold value.
	Water quality conditions at Rock Slough subject to D-1641 standards	Each month, the DCC gates are not closed if it results in violation of the D-1641 standard for Rock Slough; if DCC gates are not closed due to water quality conditions, exports during the days in question are restricted to 2,000 cfs.
December 15 – January 31	December 15-January 31	DCC Gates Closed.

2 **Flow Trigger:** It is assumed that from October 1 to December 14, the DCC will
 3 be closed if Sacramento River daily flow at Wilkins Slough exceeds 7,500 cfs.
 4 Using historical data (1945 through 2003, USGS gauge 11390500 “Sacramento
 5 River below Wilkins Slough near Grimes, CA”), a linear relationship is obtained
 6 between average monthly flow at Wilkins Slough and the number of days in
 7 month where the flow exceeds 7,500 cfs. This relation is then used to estimate
 8 the number of days of DCC closure for the October 1 to December 14 time period
 9 (Figure 5A.B.4).

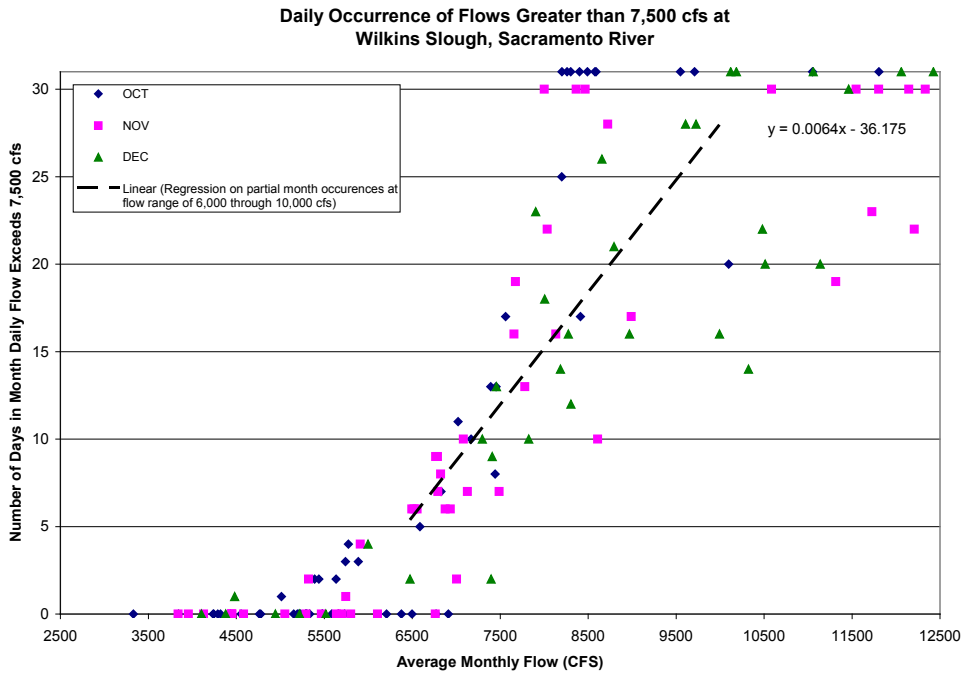

10 **Figure 5A.B.4 Relationship between monthly averages of Sacramento River flows**
 11 **and number of days that daily flow exceeds 7,500 cfs in a month at Wilkins Slough**

1 It is assumed that from December 15 through January 31 that the DCC gates are
2 closed under all flow conditions.

3 **Water Quality:** It is assumed that during the October 1 – December 14 time
4 period, the DCC gates may remain open if water quality is a concern. Using the
5 CalSim II-ANN flow-salinity model for Rock Slough, the current month’s
6 chloride level at Rock Slough is estimated assuming DCC closure per NMFS BO.
7 The estimated chloride level is compared against the Rock Slough chloride
8 standard (monthly average). If estimated chloride level exceeds the standard, the
9 gate closure is modeled per D-1641 schedule (for the entire month).

10 It is assumed that during the December 15 through January 31 time period the
11 DCC gates are closed under all water quality conditions.

12 **Export Restriction:** During the October 1 to December 14 time period, if the
13 flow trigger condition is such that additional days of DCC gates closed is called
14 for, however water quality conditions are a concern and the DCC gates remain
15 open, then Delta exports are limited to 2,000 cfs for each day in question. A
16 monthly Delta export restriction is calculated based on the trigger and water
17 quality conditions described above.

18 **Rationale:** The proposed representation in CalSim II should adequately represent
19 the limited water quality concerns are that Sacramento River flows are low during
20 the extreme high tides of December.

21 **5A.B9.1.9 Action Suite 4.2 Delta Flow Management**

22 **5A.B9.1.9.1 Action 4.2.1 San Joaquin River Inflow to Export Ratio**

23 Objectives: To reduce the vulnerability of emigrating Central Valley Steelhead
24 within the lower San Joaquin River to entrainment into the channels of the South
25 Delta and at the pumps due to the diversion of water by the export facilities in the
26 South Delta, by increasing the inflow to export ratio. To enhance the likelihood
27 of salmonids successfully exiting the Delta at Chipps Island by creating more
28 suitable hydraulic conditions in the main stem of the San Joaquin River for
29 emigrating fish, including greater net downstream flows.

30 Action: For CVP and SWP operations under this action, “The Phase II:
31 Operations beginning is 2012” is assumed. From April 1 through May 31,
32 (1) Reclamation shall continue to implement the Goodwin flow schedule for the
33 Stanislaus River prescribed in Action 3.1.3 and Appendix 2-E of the NMFS BO);
34 and (2) Combined CVP and SWP exports shall be restricted to the ratio depicted
35 in table 5A.B.35 below based on the applicable San Joaquin River Index, but will
36 be no less than 1,500 cfs (consistent with the health and safety provision
37 governing this action.)

38 *Action 4.2.1 Assumptions for CalSim II Modeling Purposes*

39 Action: Flows at Vernalis during April and May will be based on the Stanislaus
40 River flow prescribed in Action 3.1.3 and the flow contributions from the rest of
41 the San Joaquin River basin consistent with the representation of VAMP

- 1 contained in the BA modeling. In many years this flow may be less than the
 2 minimum Vernalis flow identified in the NMFS BO.
 3 Exports are restricted as illustrated in Table 5A.B.35.

4 **Table 5A.B.35 Maximum Combined CVP and SWP Export during April and May**

San Joaquin River Index	Combined CVP and SWP Export Ratio
Critically dry	1:1
Dry	2:1
Below normal	3:1
Above normal	4:1
Wet	4:1

- 5 **Rationale:** Although the described model representation does not produce the full
 6 Vernalis flow objective outlined in the NMFS BO, it does include the elements
 7 that are within the control of the CVP and SWP, and that are reasonably certain to
 8 occur for the purpose of the EIS/EIR modeling.

- 9 In the long-term, a future SWRCB flow standard at Vernalis may potentially
 10 incorporate the full flow objective identified in the BO; and the Merced and
 11 Tuolumne flows would be based on the outcome of the current SWRCB and
 12 Federal Energy Regulatory Commission (FERC) processes that are underway.

13 **5A.B9.1.10 Action 4.2.3 Old and Middle River Flow Management**

- 14 **Objective:** Reduce the vulnerability of emigrating juvenile winter-run, yearling
 15 spring-run, and Central Valley Steelhead within the lower Sacramento and
 16 San Joaquin rivers to entrainment into the channels of the South Delta and at the
 17 pumps due to the diversion of water by the export facilities in the South Delta.
 18 Enhance the likelihood of salmonids successfully exiting the Delta at Chippis
 19 Island by creating more suitable hydraulic conditions in the mainstem of the
 20 San Joaquin River for emigrating fish, including greater net downstream flows.

- 21 **Action:** From January 1 through June 15, reduce exports, as necessary, to limit
 22 negative flows to -2,500 to -5,000 cfs in Old and Middle Rivers, depending on the
 23 presence of salmonids. The reverse flow will be managed within this range to
 24 reduce flows toward the pumps during periods of increased salmonid presence.
 25 Refer to NMFS BO document for the negative flow objective decision tree.

26 **5A.B9.1.11 Action 4.2.3 Assumptions for CalSim II Modeling Purposes**

- 27 **Action:** Old and Middle River flows required in this BO are assumed to be
 28 covered by OMR flow requirements developed for actions 1 through 3 of the
 29 USFWS BO Most Likely Scenario.

- 30 **Rationale:** Based on a review of available data, it appears that implementation of
 31 actions 1 through 3 of the USFWS RPA, and action 4.2.1 of the NOAA RPA will
 32 adequately cover this action within the CalSim II simulation. If necessary,
 33 additional post-processing of results could be conducted to verify this assumption.

1 Although the described model representation does not produce the full Vernalis
 2 flow objective outlined in the NMFS BO, it does include the elements that are
 3 within the control of the CVP and SWP, and that are reasonably certain to occur
 4 for the purpose of the EIS/EIR modeling.

5 In the long-term, a future SWRCB flow standard at Vernalis may potentially
 6 incorporate the full flow objective identified in the BO; and the Merced and
 7 Tuolumne flows would be based on the outcome of the current SWRCB and
 8 FERC processes that are underway.

9 **5A.B9.1.12 Action 4.2.3 Old and Middle River Flow Management**

10 **Objective:** Reduce the vulnerability of emigrating juvenile winter-run, yearling
 11 spring-run, and Central Valley Steelhead within the lower Sacramento and
 12 San Joaquin rivers to entrainment into the channels of the South Delta and at the
 13 pumps due to the diversion of water by the export facilities in the South Delta.
 14 Enhance the likelihood of salmonids successfully exiting the Delta at Chippis
 15 Island by creating more suitable hydraulic conditions in the mainstem of the
 16 San Joaquin River for emigrating fish, including greater net downstream flows.

17 **Action:** From January 1 through June 15, reduce exports, as necessary, to limit
 18 negative flows to -2,500 to -5,000 cfs in Old and Middle Rivers, depending on the
 19 presence of salmonids. The reverse flow will be managed within this range to
 20 reduce flows toward the pumps during periods of increased salmonid presence.
 21 Refer to NMFS BO document for the negative flow objective decision tree.

22 **5A.B9.1.12.1 Action 4.2.3 Assumptions for CalSim II Modeling Purposes**

23 **Action:** Old and Middle River flows required in this BO are assumed to be
 24 covered by OMR flow requirements developed for actions 1 through 3 of the
 25 USFWS BO Most Likely Scenario.

26 **Rationale:** Based on a review of available data, it appears that implementation of
 27 actions 1 through 3 of the USFWS RPA, and action 4.2.1 of the NOAA RPA will
 28 adequately cover this action within the CalSim II simulation. If necessary,
 29 additional post-processing of results could be conducted to verify this assumption.

30 **5A.B10 References**

31 DWR (California Department of Water Resources). 2009. *DSM2 Recalibration*.
 32 Prepared for California Department of Water Resources. October.

33 DWR, Reclamation, USFWS and NMFS (California Department of Water
 34 Resources, Bureau of Reclamation, U.S. Fish and Wildlife Service, and
 35 National Marine Fisheries Service). 2013. *Draft Environmental Impact
 36 Report/Environmental Impact Statement for the Bay Delta Conservation
 37 Plan*. November.

- 1 OID, SSJID, SEWD (Oakdale Irrigation District, South San Joaquin Irrigation
2 District, Stockton East Water District). 2012. Letter to Ms. Janice Piñero,
3 Bureau of Reclamation, *Comments on Scope of the Environmental Impact
4 Statement Concerning Modifications to the Continued Long-Term
5 Operation of the Central Valley Project, In A Coordinated Manner with
6 the State Water Project*. June 28.
- 7 SWRCB (State Water Resources Control Board). 2000. *Revised Water Right
8 Decision 1641*. March 15.
- 9 Reclamation (Bureau of Reclamation). 2006. *Lower American River Flow
10 Management Standard. Draft Report*. July 31.
- 11 _____. 2008a. *Central Valley Project and State Water Project Operations
12 Criteria and Plan Biological Assessment, Appendix D CalSim-II Model*.
13 May.
- 14 _____. 2008b. *Central Valley Project and State Water Project Operations
15 Criteria and Plan Biological Assessment, Appendix F DSM2 Model*. May.

1 Appendix 5A, Section C

2 CalSim II and DSM2 Modeling Results

3 5A.1 Introduction

4 This appendix provides CalSim II and DSM2 model simulation results for
5 alternatives evaluated for the EIS. Figures and tables are provided to illustrate
6 and summarize the results. The different types of presentations are explained
7 below.

8 **Probability of Exceedance Plots.** Probability of exceedance plots provide the
9 frequency of occurrence of values of a parameter that exceed a reference value.
10 For this appendix, the calculation of exceedance probability is done by ranking
11 the data. For example, for the Shasta storage end of September exceedance plot,
12 Shasta storage values at the end of September for each simulated year are sorted
13 in ascending order. The smallest value would have a probability of exceedance of
14 100 percent since all other values would be greater than that value, and the largest
15 value would have a probability of exceedance of 0 percent. All the values are
16 plotted with probability of exceedance on the x-axis and the value of the
17 parameter on the y-axis. Following the same example, if for one scenario, Shasta
18 end of September of 2,000 TAF corresponds to 80 percent probability, it implies
19 that Shasta end-of September storage is higher than 2,000 TAF in 80 percent of
20 the years under the simulated conditions.

21 **Box and Whisker Diagrams.** These plots display the distribution of data based
22 on the following statistical summary: minimum, first quartile (25th percentile that
23 corresponds to 75 percent exceedance probability), mean, median (50 percent
24 exceedance probability), third quartile (75th percentile that corresponds to
25 25 percent exceedance probability), and maximum.

26 **Monthly Pattern Plots.** Monthly pattern plots provide average values for a
27 parameter for each month of the year. The averaging may be done on a long-term
28 basis, which means that it is being averaged over the full number of simulated
29 years, or it may be done for a set of simulated years that have a certain year type.
30 In this appendix, year types are determined using the Sacramento Valley 40-30-30
31 Index developed by the State Water Resources Control Board (SWRCB). In this
32 appendix, for year type based averages, the year type for each simulated year is
33 assumed to be the classification of the year under projected climate at Year 2030
34 conditions. This type of plot is used to obtain insight to the monthly variation of
35 phenomena throughout the year.

36 **Long-Term Average Summary and Year Type Based Statistics Summary**
37 **Tables.** These tables provide parameter values for each 10 percent increment of
38 exceedance probability (rows) for each month (columns) as well as long-term and
39 year-type averages (using the Sacramento Valley 40-30-30 Index developed by
40 the SWRCB for projected climate at Year 2030) for each month. For a few

1 parameters, such as Delta outflow, annual total or average values are added to the
2 tables (for volume and rates, respectively).

3 **Long-Term Average Summary and Dry and Critical Year Type Based**
4 **Summary Tables.** These tables are primarily used to report average annual
5 Central Valley Project (CVP) and State Water Project (SWP) deliveries for each
6 hydrologic region. Values are averaged either for all the years (long-term) or for
7 dry and critical years (using the Sacramento Valley 40-30-30 Index developed by
8 the SWRCB for projected climate at Year 2030). This table is also provided in a
9 format that summarizes SWP and CVP agricultural and municipal and industrial
10 deliveries to the north and south of Delta.

11 **Long-Term Average Summary for SWP Table A and Article 21 Deliveries.**
12 This table provides firm and intermittent SWP deliveries on a long-term average
13 basis.

14 All plots and tables were prepared to facilitate the following comparisons:

- 15 • No Action Alternative (with climate change and sea-level rise at Year 2030)
16 compared to the Second Basis of Comparison (with climate change and sea-
17 level rise at Year 2030)
- 18 • Alternatives (with climate change and sea-level rise at Year 2030) compared
19 to the No Action Alternative
- 20 • Alternatives (with climate change and sea-level rise at Year 2030) compared
21 to the Second Basis of Comparison

22 **5A.2 Appropriate Use of Model Results**

23 The physical models developed and applied in the Environmental Impact
24 Statement (EIS) analysis are generalized and simplified representations of a
25 complex water resources system. A brief description of appropriate use of the
26 model results to compare two scenarios or to compare against threshold values or
27 standards is presented below.

28 **5A.2.1 Absolute vs. Relative Use of the Model Results**

29 The models are not predictive models (in how they are applied in this project),
30 and therefore the results cannot be considered as absolute with and within a
31 quantifiable confidence interval. The model results are only useful in a
32 comparative analysis and can only serve as an indicator of condition (e.g.,
33 compliance with a standard) and of trends (e.g., generalized impacts).

34 **5A.2.2 Appropriate Reporting Time-Step**

35 Due to the assumptions involved in the input data sets and model logic, care must
36 be taken to select the most appropriate time-step for the reporting of model
37 results. Sub-monthly (e.g., weekly or daily) reporting of model results is
38 inappropriate for all models and the results should be presented and interpreted on
39 a monthly basis.

1 **5A.2.3 Statistical Comparisons**

2 Absolute differences computed at a point in time between model results from an
3 alternative and a baseline to evaluate impacts is an inappropriate use of model
4 results (e.g., computing differences between the results from a baseline and an
5 alternative for a particular day or month and year within the period of record of
6 simulation). Likewise computing absolute differences between an alternative (or
7 a baseline) and a specific threshold value or standard is an inappropriate use of
8 model results. Statistics computed based on the absolute differences at a point in
9 time (e.g., average of monthly differences) are an inappropriate use of model
10 results. Computing the absolute differences in this way disregards the changes in
11 antecedent conditions between individual scenarios and distorts the evaluation of
12 impacts of a specific action.

13 Reporting seasonal patterns from long-term averages and water year type
14 averages is appropriate. Statistics computed based on long-term and water year
15 type averages are an appropriate use of model results. Computing differences
16 between long-term or water year type averages of model results from two
17 scenarios are appropriate. Care should be taken to use the appropriate water year
18 type for presenting water year type average statistics of model results (e.g., D1641
19 Sacramento River 40-30-30 or San Joaquin River 60-20-20 based on climate
20 modifications). For this study, water year types are based on the projected
21 climate and hydrology at Year 2030.

22 The most appropriate presentation of monthly and annual model results is in the
23 form of probability distributions and comparisons of probability distributions
24 (e.g., cumulative probabilities). If necessary, comparisons of model results
25 against threshold or standard values should be limited to comparisons based on
26 cumulative probability distributions.

27 **5A.3 CalSim II and DSM2 Model Results**

28 CalSim II and DSM2 model results are presented in the figures at the end of this
29 section as follows:

- 30 • C.1. Trinity Storage
- 31 • C.2. Shasta Storage
- 32 • C.3. Oroville Storage
- 33 • C.4. Folsom Storage
- 34 • C.5. San Luis Storage
- 35 • C.6. New Melones Storage
- 36 • C.7. Millerton Storage
- 37 • C.8. Trinity Lake Elevation
- 38 • C.9. Shasta Lake Elevation


- 1 • C.10. Oroville Lake Elevation
- 2 • C.11. Folsom Lake Elevation
- 3 • C.12. San Luis Lake Elevation
- 4 • C.13. New Melones Elevation
- 5 • C.14. Millerton Elevation
- 6 • C.15. Delta Outflow
- 7 • C.16. X2 Position
- 8 • C.17. Old and Middle River Flow
- 9 • C.18. Exports through Jones and Banks Pumping Plants
- 10 • C.19. CVP Deliveries
- 11 • C.20. SWP Deliveries
- 12 • C.21. Trinity River Flow below Lewiston
- 13 • C.22. Clear Creek Flow below Whiskeytown
- 14 • C.23. Sacramento River Flow downstream of Keswick Reservoir
- 15 • C.24. Sacramento River Flow at Bend Bridge
- 16 • C.25. Feather River Flow downstream of Thermalito
- 17 • C.26. Fremont Weir Spills
- 18 • C.27. American River Flow downstream of Nimbus
- 19 • C.28. Sacramento River Flow at Freeport
- 20 • C.29. Yolo Bypass Flow
- 21 • C.30. Sacramento River Flow a Rio Vista
- 22 • C.31. Delta Cross Channel Flow
- 23 • C.32. Sutter and Steamboat Slough Flows
- 24 • C.33. Qwest Flow
- 25 • C.34. San Joaquin River Flow at Vernalis
- 26 • C.35. Stanislaus River Flow below Goodwin
- 27 • C.36. Stanislaus River Flow at Mouth
- 28 • C.37. San Joaquin River Flow downstream of Merced River Confluence
- 29 • C.38. San Joaquin River Restoration Flow
- 30 • C.39. San Joaquin River Flow at Vernalis minus San Joaquin River Flow
- 31 downstream of Merced River Confluence

- 1 • C.40. Steamboat Slough downstream of Sutter Slough Water Surface
- 2 Elevation
- 3 • C.41. Old River at Tracy Boulevard Water Surface Elevation
- 4 • C.42. Mokelumne River at Terminus Water Surface Elevation
- 5 • C.43. Sacramento River at Freeport Water Surface Elevation
- 6 • C.44. Sacramento River downstream of Delta Cross Channel Water Surface
- 7 Elevation
- 8 • C.45. Sacramento River at Rio Vista Water Surface Elevation

This page left blank intentionally.


1 **C.1. Trinity Storage**

Figure C-1-1. Trinity Lake, End of May Storage

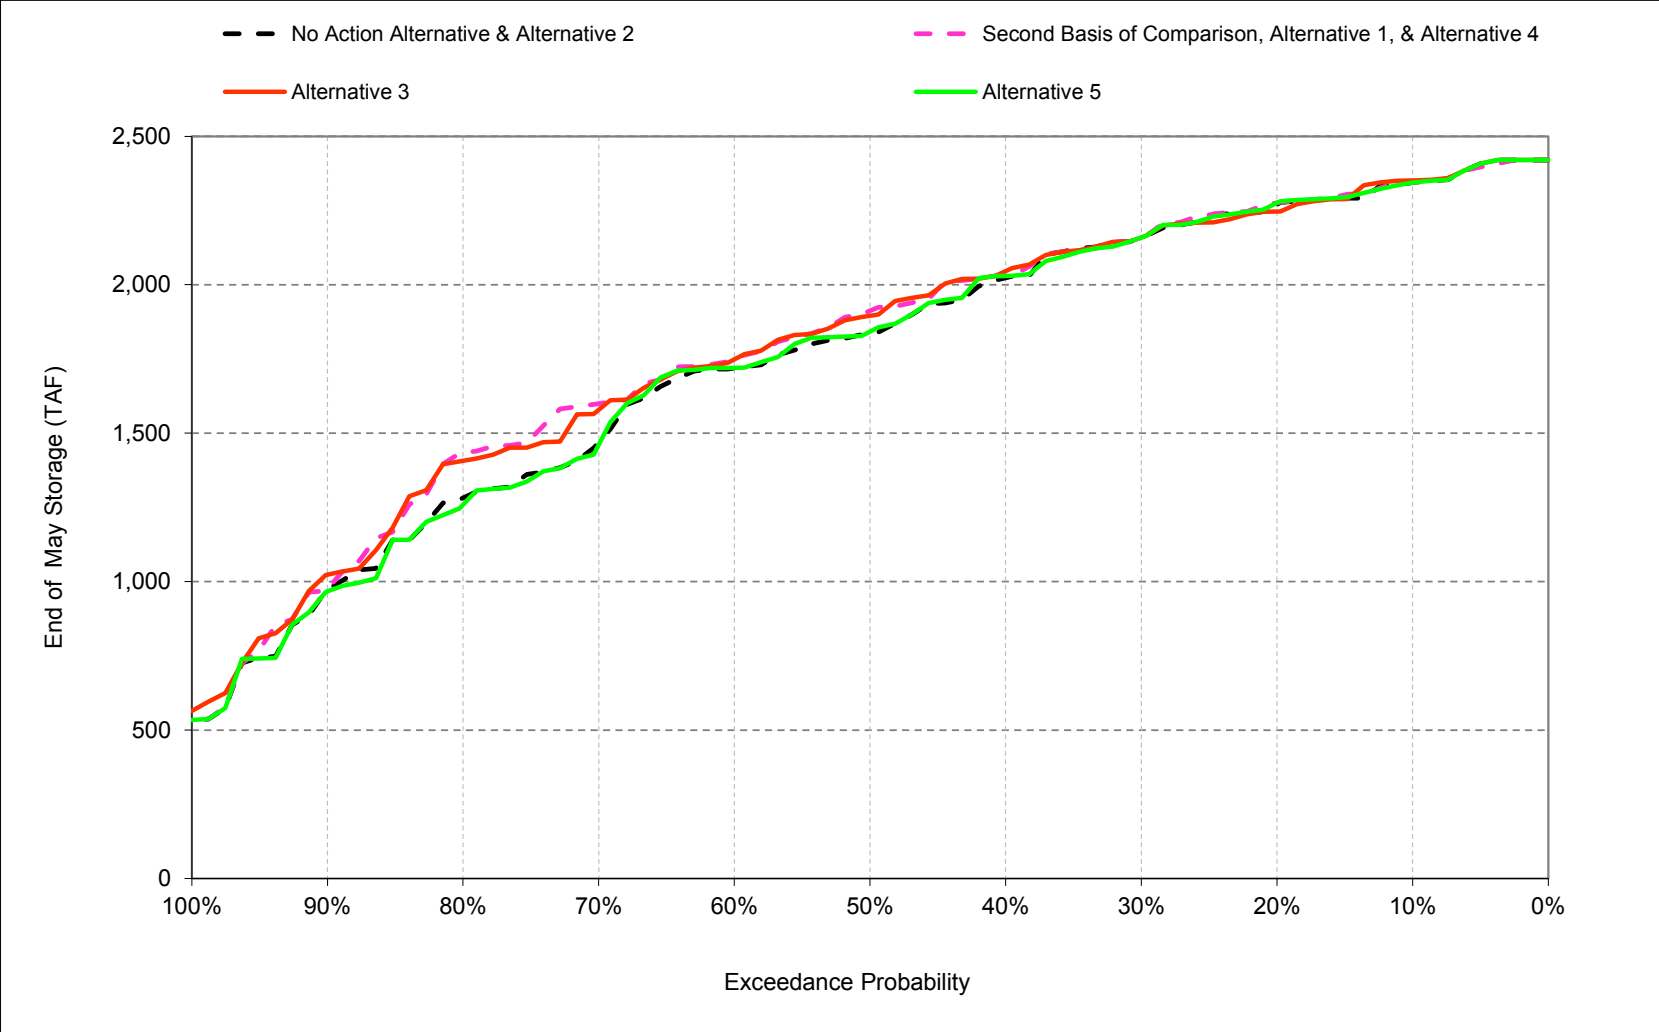

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-1-2. Trinity Lake, End of September Storage

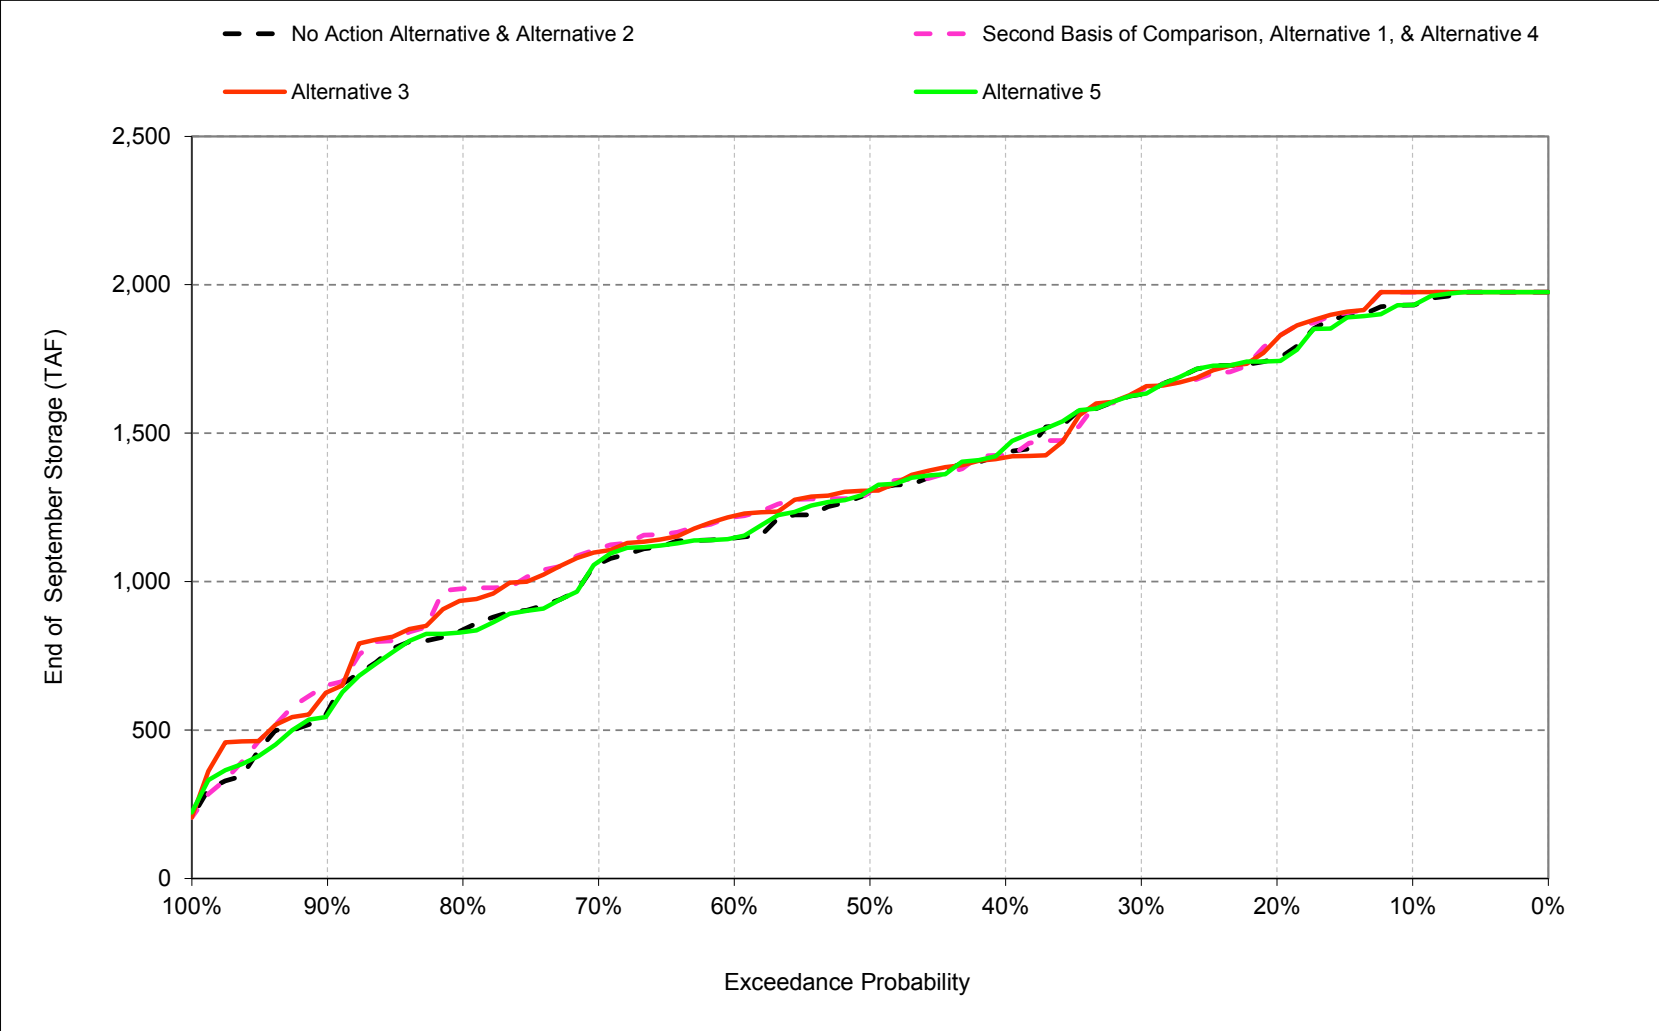

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-1-1. Trinity Lake, End of Month Storage

No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,850	1,833	1,850	1,900	2,000	2,100	2,284	2,344	2,306	2,261	2,143	1,932
20%	1,764	1,735	1,797	1,889	2,000	2,100	2,251	2,271	2,207	2,064	1,905	1,753
30%	1,542	1,579	1,679	1,774	1,951	2,079	2,218	2,159	2,055	1,913	1,776	1,631
40%	1,383	1,370	1,557	1,673	1,769	1,982	2,115	2,024	1,916	1,774	1,583	1,432
50%	1,217	1,242	1,368	1,500	1,665	1,766	1,908	1,836	1,708	1,563	1,414	1,302
60%	1,119	1,154	1,235	1,277	1,496	1,668	1,793	1,719	1,628	1,423	1,264	1,147
70%	1,033	1,023	1,104	1,154	1,253	1,365	1,486	1,470	1,394	1,283	1,153	1,060
80%	831	855	876	973	1,033	1,139	1,312	1,282	1,222	1,058	924	838
90%	547	592	620	629	734	920	989	973	914	790	599	562
Long Term												
Full Simulation Period ^b	1,233	1,242	1,306	1,385	1,510	1,637	1,779	1,756	1,687	1,549	1,405	1,286
Water Year Types^c												
Wet (32%)	1,490	1,516	1,630	1,756	1,921	2,053	2,220	2,245	2,190	2,067	1,939	1,784
Above Normal (16%)	1,159	1,178	1,286	1,455	1,658	1,847	2,025	1,999	1,907	1,773	1,619	1,495
Below Normal (13%)	1,393	1,400	1,417	1,488	1,575	1,662	1,817	1,743	1,637	1,470	1,304	1,185
Dry (24%)	1,152	1,148	1,174	1,182	1,274	1,403	1,539	1,490	1,413	1,253	1,104	1,008
Critical (15%)	747	731	746	750	790	872	923	888	862	745	612	536

Alternative 1												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,850	1,850	1,850	1,900	2,000	2,100	2,298	2,345	2,302	2,253	2,143	1,975
20%	1,804	1,840	1,850	1,900	2,000	2,100	2,255	2,276	2,193	2,055	1,920	1,822
30%	1,576	1,594	1,740	1,816	1,981	2,091	2,222	2,159	2,074	1,924	1,793	1,645
40%	1,391	1,446	1,568	1,705	1,855	2,019	2,131	2,030	1,918	1,767	1,582	1,426
50%	1,267	1,266	1,396	1,567	1,685	1,818	2,012	1,912	1,773	1,601	1,416	1,304
60%	1,174	1,201	1,230	1,335	1,535	1,709	1,778	1,749	1,677	1,497	1,330	1,218
70%	1,106	1,099	1,179	1,216	1,362	1,484	1,645	1,599	1,537	1,400	1,225	1,111
80%	948	954	983	1,052	1,132	1,274	1,453	1,434	1,338	1,168	1,055	976
90%	634	645	672	724	810	921	1,051	975	917	802	689	651
Long Term												
Full Simulation Period ^b	1,269	1,288	1,352	1,431	1,554	1,678	1,819	1,796	1,727	1,583	1,434	1,319
Water Year Types^c												
Wet (32%)	1,501	1,535	1,644	1,767	1,931	2,055	2,224	2,250	2,194	2,068	1,939	1,805
Above Normal (16%)	1,208	1,245	1,363	1,524	1,718	1,901	2,079	2,053	1,955	1,815	1,647	1,513
Below Normal (13%)	1,451	1,472	1,492	1,554	1,641	1,729	1,872	1,799	1,696	1,515	1,337	1,204
Dry (24%)	1,178	1,184	1,210	1,230	1,322	1,453	1,586	1,536	1,466	1,302	1,152	1,055
Critical (15%)	819	803	813	825	868	949	999	962	929	811	667	598

Alternative 1 minus No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	17	0	0	0	0	14	1	-4	-8	-1	43
20%	40	105	53	11	0	0	3	5	-14	-9	15	69
30%	34	15	62	42	30	12	5	0	18	12	17	15
40%	8	76	11	32	86	36	17	6	2	-8	-1	-6
50%	50	25	28	67	20	52	104	76	65	38	2	2
60%	55	47	-6	59	39	40	-14	30	49	74	66	71
70%	74	76	75	62	110	119	159	130	143	117	73	51
80%	117	100	107	79	99	136	141	152	117	110	131	139
90%	87	53	52	95	77	1	62	2	3	12	90	89
Long Term												
Full Simulation Period ^b	36	46	45	46	44	42	40	40	40	34	28	33
Water Year Types^c												
Wet (32%)	11	19	14	11	9	2	4	5	4	0	-1	21
Above Normal (16%)	49	68	77	69	60	54	55	54	49	42	27	18
Below Normal (13%)	59	72	74	66	67	67	54	57	60	44	33	18
Dry (24%)	26	36	36	48	48	49	47	46	53	48	48	48
Critical (15%)	73	72	68	75	78	78	76	74	66	66	56	61

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-1-2. Trinity Lake, End of Month Storage

No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,850	1,833	1,850	1,900	2,000	2,100	2,284	2,344	2,306	2,261	2,143	1,932
20%	1,764	1,735	1,797	1,889	2,000	2,100	2,251	2,271	2,207	2,064	1,905	1,753
30%	1,542	1,579	1,679	1,774	1,951	2,079	2,218	2,159	2,055	1,913	1,776	1,631
40%	1,383	1,370	1,557	1,673	1,769	1,982	2,115	2,024	1,916	1,774	1,583	1,432
50%	1,217	1,242	1,368	1,500	1,665	1,766	1,908	1,836	1,708	1,563	1,414	1,302
60%	1,119	1,154	1,235	1,277	1,496	1,668	1,793	1,719	1,628	1,423	1,264	1,147
70%	1,033	1,023	1,104	1,154	1,253	1,365	1,486	1,470	1,394	1,283	1,153	1,060
80%	831	855	876	973	1,033	1,139	1,312	1,282	1,222	1,058	924	838
90%	547	592	620	629	734	920	989	973	914	790	599	562
Long Term												
Full Simulation Period ^b	1,233	1,242	1,306	1,385	1,510	1,637	1,779	1,756	1,687	1,549	1,405	1,286
Water Year Types^c												
Wet (32%)	1,490	1,516	1,630	1,756	1,921	2,053	2,220	2,245	2,190	2,067	1,939	1,784
Above Normal (16%)	1,159	1,178	1,286	1,455	1,658	1,847	2,025	1,999	1,907	1,773	1,619	1,495
Below Normal (13%)	1,393	1,400	1,417	1,488	1,575	1,662	1,817	1,743	1,637	1,470	1,304	1,185
Dry (24%)	1,152	1,148	1,174	1,182	1,274	1,403	1,539	1,490	1,413	1,253	1,104	1,008
Critical (15%)	747	731	746	750	790	872	923	888	862	745	612	536

Alternative 3												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,850	1,850	1,850	1,900	2,000	2,100	2,298	2,351	2,298	2,211	2,100	1,975
20%	1,815	1,831	1,849	1,900	2,000	2,100	2,259	2,246	2,204	2,064	1,903	1,818
30%	1,583	1,614	1,719	1,803	1,968	2,069	2,222	2,159	2,064	1,925	1,794	1,649
40%	1,365	1,400	1,572	1,671	1,858	1,995	2,104	2,046	1,937	1,759	1,581	1,419
50%	1,257	1,259	1,420	1,588	1,700	1,823	1,990	1,895	1,784	1,599	1,418	1,307
60%	1,169	1,205	1,233	1,318	1,536	1,721	1,787	1,748	1,674	1,495	1,334	1,221
70%	1,100	1,095	1,187	1,200	1,344	1,472	1,629	1,579	1,525	1,385	1,223	1,100
80%	909	956	961	1,041	1,155	1,250	1,429	1,407	1,322	1,160	1,019	937
90%	628	630	623	681	790	921	1,065	1,023	965	843	690	628
Long Term												
Full Simulation Period ^b	1,266	1,283	1,347	1,427	1,550	1,674	1,816	1,793	1,724	1,580	1,432	1,318
Water Year Types^c												
Wet (32%)	1,502	1,537	1,643	1,766	1,928	2,053	2,224	2,248	2,192	2,067	1,936	1,805
Above Normal (16%)	1,197	1,230	1,349	1,511	1,707	1,891	2,071	2,045	1,949	1,806	1,646	1,513
Below Normal (13%)	1,434	1,457	1,477	1,542	1,629	1,717	1,858	1,786	1,680	1,509	1,334	1,199
Dry (24%)	1,173	1,179	1,206	1,226	1,318	1,450	1,585	1,537	1,468	1,301	1,152	1,056
Critical (15%)	829	803	817	829	871	952	1,003	968	936	813	664	600

Alternative 3 minus No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	17	0	0	0	0	14	7	-8	-50	-43	43
20%	51	96	52	11	0	0	8	-25	-3	0	-2	65
30%	41	35	41	28	17	-10	4	0	8	12	18	19
40%	-18	30	15	-2	89	13	-11	22	21	-15	-2	-14
50%	39	17	52	88	35	57	82	59	76	36	4	5
60%	49	50	-2	41	39	52	-5	29	46	72	70	74
70%	67	72	83	46	92	108	143	109	130	102	70	41
80%	77	102	85	69	122	111	117	125	100	101	95	99
90%	81	39	3	52	56	2	76	50	52	53	92	66
Long Term												
Full Simulation Period ^b	32	41	40	42	40	38	37	37	37	32	27	32
Water Year Types^c												
Wet (32%)	11	21	13	10	7	0	3	4	3	0	-3	21
Above Normal (16%)	38	53	63	56	49	45	46	46	42	33	27	18
Below Normal (13%)	41	57	60	54	55	55	40	43	43	38	30	13
Dry (24%)	21	31	32	45	44	47	46	47	55	48	48	48
Critical (15%)	82	73	71	79	81	81	80	80	73	68	53	64

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-1-3. Trinity Lake, End of Month Storage

No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,850	1,833	1,850	1,900	2,000	2,100	2,284	2,344	2,306	2,261	2,143	1,932
20%	1,764	1,735	1,797	1,889	2,000	2,100	2,251	2,271	2,207	2,064	1,905	1,753
30%	1,542	1,579	1,679	1,774	1,951	2,079	2,218	2,159	2,055	1,913	1,776	1,631
40%	1,383	1,370	1,557	1,673	1,769	1,982	2,115	2,024	1,916	1,774	1,583	1,432
50%	1,217	1,242	1,368	1,500	1,665	1,766	1,908	1,836	1,708	1,563	1,414	1,302
60%	1,119	1,154	1,235	1,277	1,496	1,668	1,793	1,719	1,628	1,423	1,264	1,147
70%	1,033	1,023	1,104	1,154	1,253	1,365	1,486	1,470	1,394	1,283	1,153	1,060
80%	831	855	876	973	1,033	1,139	1,312	1,282	1,222	1,058	924	838
90%	547	592	620	629	734	920	989	973	914	790	599	562
Long Term												
Full Simulation Period ^b	1,233	1,242	1,306	1,385	1,510	1,637	1,779	1,756	1,687	1,549	1,405	1,286
Water Year Types^c												
Wet (32%)	1,490	1,516	1,630	1,756	1,921	2,053	2,220	2,245	2,190	2,067	1,939	1,784
Above Normal (16%)	1,159	1,178	1,286	1,455	1,658	1,847	2,025	1,999	1,907	1,773	1,619	1,495
Below Normal (13%)	1,393	1,400	1,417	1,488	1,575	1,662	1,817	1,743	1,637	1,470	1,304	1,185
Dry (24%)	1,152	1,148	1,174	1,182	1,274	1,403	1,539	1,490	1,413	1,253	1,104	1,008
Critical (15%)	747	731	746	750	790	872	923	888	862	745	612	536

Alternative 5												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,850	1,828	1,850	1,900	2,000	2,100	2,283	2,344	2,306	2,262	2,143	1,932
20%	1,764	1,735	1,803	1,889	2,000	2,100	2,250	2,276	2,207	2,064	1,893	1,743
30%	1,542	1,577	1,694	1,779	1,954	2,084	2,220	2,159	2,055	1,913	1,776	1,631
40%	1,427	1,373	1,560	1,683	1,770	1,994	2,131	2,029	1,921	1,779	1,600	1,453
50%	1,231	1,253	1,376	1,518	1,671	1,771	1,895	1,842	1,728	1,563	1,420	1,309
60%	1,127	1,172	1,247	1,279	1,493	1,669	1,798	1,720	1,634	1,479	1,271	1,148
70%	1,051	1,037	1,098	1,146	1,250	1,378	1,484	1,460	1,390	1,268	1,139	1,067
80%	834	850	879	977	1,036	1,141	1,321	1,259	1,209	1,066	941	830
90%	537	589	594	628	733	908	983	967	922	811	607	553
Long Term												
Full Simulation Period ^b	1,235	1,244	1,309	1,387	1,512	1,638	1,779	1,756	1,688	1,553	1,411	1,288
Water Year Types^c												
Wet (32%)	1,494	1,520	1,635	1,759	1,926	2,056	2,222	2,246	2,191	2,068	1,940	1,781
Above Normal (16%)	1,155	1,180	1,290	1,459	1,662	1,850	2,030	2,004	1,912	1,778	1,627	1,503
Below Normal (13%)	1,398	1,405	1,422	1,493	1,580	1,667	1,813	1,741	1,637	1,474	1,311	1,190
Dry (24%)	1,155	1,150	1,175	1,183	1,275	1,404	1,540	1,492	1,415	1,259	1,110	1,012
Critical (15%)	744	726	741	743	784	866	913	878	856	755	622	539

Alternative 5 minus No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	-5	0	0	0	0	-1	0	0	1	0	0
20%	0	0	7	0	0	0	-1	5	0	0	-12	-10
30%	0	-2	15	5	2	5	3	0	0	0	0	0
40%	45	3	2	9	1	12	16	6	5	5	17	21
50%	14	12	7	18	6	5	-13	6	19	0	6	7
60%	7	17	12	3	-3	1	5	1	5	56	7	1
70%	18	14	-6	-8	-3	14	-2	-9	-5	-15	-14	8
80%	3	-4	3	4	3	3	9	-23	-13	7	17	-8
90%	-10	-3	-26	-1	-1	-12	-7	-6	8	22	8	-10
Long Term												
Full Simulation Period ^b	1	2	3	2	2	1	0	0	1	4	5	2
Water Year Types^c												
Wet (32%)	4	3	5	4	4	2	2	2	2	0	0	-2
Above Normal (16%)	-4	2	4	4	4	4	6	6	5	5	8	8
Below Normal (13%)	5	5	5	5	5	5	-5	-2	0	4	7	4
Dry (24%)	3	1	1	1	1	1	1	1	2	6	6	4
Critical (15%)	-2	-5	-4	-7	-6	-6	-10	-10	-7	10	11	3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-1-4. Trinity Lake, End of Month Storage

Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,850	1,850	1,850	1,900	2,000	2,100	2,298	2,345	2,302	2,253	2,143	1,975
20%	1,804	1,840	1,850	1,900	2,000	2,100	2,255	2,276	2,193	2,055	1,920	1,822
30%	1,576	1,594	1,740	1,816	1,981	2,091	2,222	2,159	2,074	1,924	1,793	1,645
40%	1,391	1,446	1,568	1,705	1,855	2,019	2,131	2,030	1,918	1,767	1,582	1,426
50%	1,267	1,266	1,396	1,567	1,685	1,818	2,012	1,912	1,773	1,601	1,416	1,304
60%	1,174	1,201	1,230	1,335	1,535	1,709	1,778	1,749	1,677	1,497	1,330	1,218
70%	1,106	1,099	1,179	1,216	1,362	1,484	1,645	1,599	1,537	1,400	1,225	1,111
80%	948	954	983	1,052	1,132	1,274	1,453	1,434	1,338	1,168	1,055	976
90%	634	645	672	724	810	921	1,051	975	917	802	689	651
Long Term												
Full Simulation Period ^b	1,269	1,288	1,352	1,431	1,554	1,678	1,819	1,796	1,727	1,583	1,434	1,319
Water Year Types^c												
Wet (32%)	1,501	1,535	1,644	1,767	1,931	2,055	2,224	2,250	2,194	2,068	1,939	1,805
Above Normal (16%)	1,208	1,245	1,363	1,524	1,718	1,901	2,079	2,053	1,955	1,815	1,647	1,513
Below Normal (13%)	1,451	1,472	1,492	1,554	1,641	1,729	1,872	1,799	1,696	1,515	1,337	1,204
Dry (24%)	1,178	1,184	1,210	1,230	1,322	1,453	1,586	1,536	1,466	1,302	1,152	1,055
Critical (15%)	819	803	813	825	868	949	999	962	929	811	667	598

No Action Alternative

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,850	1,833	1,850	1,900	2,000	2,100	2,284	2,344	2,306	2,261	2,143	1,932
20%	1,764	1,735	1,797	1,889	2,000	2,100	2,251	2,271	2,207	2,064	1,905	1,753
30%	1,542	1,579	1,679	1,774	1,951	2,079	2,218	2,159	2,055	1,913	1,776	1,631
40%	1,383	1,370	1,557	1,673	1,769	1,982	2,115	2,024	1,916	1,774	1,583	1,432
50%	1,217	1,242	1,368	1,500	1,665	1,766	1,908	1,836	1,708	1,563	1,414	1,302
60%	1,119	1,154	1,235	1,277	1,496	1,668	1,793	1,719	1,628	1,423	1,264	1,147
70%	1,033	1,023	1,104	1,154	1,253	1,365	1,486	1,470	1,394	1,283	1,153	1,060
80%	831	855	876	973	1,033	1,139	1,312	1,282	1,222	1,058	924	838
90%	547	592	620	629	734	920	989	973	914	790	599	562
Long Term												
Full Simulation Period ^b	1,233	1,242	1,306	1,385	1,510	1,637	1,779	1,756	1,687	1,549	1,405	1,286
Water Year Types^c												
Wet (32%)	1,490	1,516	1,630	1,756	1,921	2,053	2,220	2,245	2,190	2,067	1,939	1,784
Above Normal (16%)	1,159	1,178	1,286	1,455	1,658	1,847	2,025	1,999	1,907	1,773	1,619	1,495
Below Normal (13%)	1,393	1,400	1,417	1,488	1,575	1,662	1,817	1,743	1,637	1,470	1,304	1,185
Dry (24%)	1,152	1,148	1,174	1,182	1,274	1,403	1,539	1,490	1,413	1,253	1,104	1,008
Critical (15%)	747	731	746	750	790	872	923	888	862	745	612	536

No Action Alternative minus Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	-17	0	0	0	0	-14	-1	4	8	1	-43
20%	-40	-105	-53	-11	0	0	-3	-5	14	9	-15	-69
30%	-34	-15	-62	-42	-30	-12	-5	0	-18	-12	-17	-15
40%	-8	-76	-11	-32	-86	-36	-17	-6	-2	8	1	6
50%	-50	-25	-28	-67	-20	-52	-104	-76	-65	-38	-2	-2
60%	-55	-47	6	-59	-39	-40	14	-30	-49	-74	-66	-71
70%	-74	-76	-75	-62	-110	-119	-159	-130	-143	-117	-73	-51
80%	-117	-100	-107	-79	-99	-136	-141	-152	-117	-110	-131	-139
90%	-87	-53	-52	-95	-77	-1	-62	-2	-3	-12	-90	-89
Long Term												
Full Simulation Period ^b	-36	-46	-45	-46	-44	-42	-40	-40	-40	-34	-28	-33
Water Year Types^c												
Wet (32%)	-11	-19	-14	-11	-9	-2	-4	-5	-4	0	1	-21
Above Normal (16%)	-49	-68	-77	-69	-60	-54	-55	-54	-49	-42	-27	-18
Below Normal (13%)	-59	-72	-74	-66	-67	-67	-54	-57	-60	-44	-33	-18
Dry (24%)	-26	-36	-36	-48	-48	-49	-47	-46	-53	-48	-48	-48
Critical (15%)	-73	-72	-68	-75	-78	-78	-76	-74	-66	-66	-56	-61

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-1-5. Trinity Lake, End of Month Storage

Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,850	1,850	1,850	1,900	2,000	2,100	2,298	2,345	2,302	2,253	2,143	1,975
20%	1,804	1,840	1,850	1,900	2,000	2,100	2,255	2,276	2,193	2,055	1,920	1,822
30%	1,576	1,594	1,740	1,816	1,981	2,091	2,222	2,159	2,074	1,924	1,793	1,645
40%	1,391	1,446	1,568	1,705	1,855	2,019	2,131	2,030	1,918	1,767	1,582	1,426
50%	1,267	1,266	1,396	1,567	1,685	1,818	2,012	1,912	1,773	1,601	1,416	1,304
60%	1,174	1,201	1,230	1,335	1,535	1,709	1,778	1,749	1,677	1,497	1,330	1,218
70%	1,106	1,099	1,179	1,216	1,362	1,484	1,645	1,599	1,537	1,400	1,225	1,111
80%	948	954	983	1,052	1,132	1,274	1,453	1,434	1,338	1,168	1,055	976
90%	634	645	672	724	810	921	1,051	975	917	802	689	651
Long Term												
Full Simulation Period ^b	1,269	1,288	1,352	1,431	1,554	1,678	1,819	1,796	1,727	1,583	1,434	1,319
Water Year Types^c												
Wet (32%)	1,501	1,535	1,644	1,767	1,931	2,055	2,224	2,250	2,194	2,068	1,939	1,805
Above Normal (16%)	1,208	1,245	1,363	1,524	1,718	1,901	2,079	2,053	1,955	1,815	1,647	1,513
Below Normal (13%)	1,451	1,472	1,492	1,554	1,641	1,729	1,872	1,799	1,696	1,515	1,337	1,204
Dry (24%)	1,178	1,184	1,210	1,230	1,322	1,453	1,586	1,536	1,466	1,302	1,152	1,055
Critical (15%)	819	803	813	825	868	949	999	962	929	811	667	598

Alternative 3

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,850	1,850	1,850	1,900	2,000	2,100	2,298	2,351	2,298	2,211	2,100	1,975
20%	1,815	1,831	1,849	1,900	2,000	2,100	2,259	2,246	2,204	2,064	1,903	1,818
30%	1,583	1,614	1,719	1,803	1,968	2,069	2,222	2,159	2,064	1,925	1,794	1,649
40%	1,365	1,400	1,572	1,671	1,858	1,995	2,104	2,046	1,937	1,759	1,581	1,419
50%	1,257	1,259	1,420	1,588	1,700	1,823	1,990	1,895	1,784	1,599	1,418	1,307
60%	1,169	1,205	1,233	1,318	1,536	1,721	1,787	1,748	1,674	1,495	1,334	1,221
70%	1,100	1,095	1,187	1,200	1,344	1,472	1,629	1,579	1,525	1,385	1,223	1,100
80%	909	956	961	1,041	1,155	1,250	1,429	1,407	1,322	1,160	1,019	937
90%	628	630	623	681	790	921	1,065	1,023	965	843	690	628
Long Term												
Full Simulation Period ^b	1,266	1,283	1,347	1,427	1,550	1,674	1,816	1,793	1,724	1,580	1,432	1,318
Water Year Types^c												
Wet (32%)	1,502	1,537	1,643	1,766	1,928	2,053	2,224	2,248	2,192	2,067	1,936	1,805
Above Normal (16%)	1,197	1,230	1,349	1,511	1,707	1,891	2,071	2,045	1,949	1,806	1,646	1,513
Below Normal (13%)	1,434	1,457	1,477	1,542	1,629	1,717	1,858	1,786	1,680	1,509	1,334	1,199
Dry (24%)	1,173	1,179	1,206	1,226	1,318	1,450	1,585	1,537	1,468	1,301	1,152	1,056
Critical (15%)	829	803	817	829	871	952	1,003	968	936	813	664	600

Alternative 3 minus Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	0	0	0	6	-4	-42	-42	0
20%	11	-9	-1	0	0	0	5	-29	11	9	-17	-4
30%	6	21	-21	-13	-13	-22	-1	0	-10	1	1	4
40%	-26	-45	4	-34	2	-23	-27	16	20	-8	0	-8
50%	-11	-7	24	21	16	5	-22	-17	11	-2	2	3
60%	-6	3	3	-18	0	12	9	-1	-3	-2	4	3
70%	-7	-4	8	-16	-18	-12	-16	-21	-13	-15	-2	-11
80%	-39	2	-22	-10	23	-25	-24	-26	-16	-9	-36	-40
90%	-5	-14	-49	-43	-20	0	14	48	49	41	2	-23
Long Term												
Full Simulation Period ^b	-4	-5	-5	-4	-5	-4	-3	-3	-2	-2	-2	0
Water Year Types^c												
Wet (32%)	0	1	-1	-1	-2	-1	-1	-2	-1	0	-3	0
Above Normal (16%)	-11	-15	-14	-13	-11	-10	-8	-8	-7	-9	0	0
Below Normal (13%)	-17	-15	-15	-12	-12	-12	-14	-13	-16	-6	-3	-5
Dry (24%)	-5	-5	-4	-4	-4	-2	-1	0	2	0	0	1
Critical (15%)	10	1	3	3	3	3	4	6	7	2	-3	2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-1-6. Trinity Lake, End of Month Storage

Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,850	1,850	1,850	1,900	2,000	2,100	2,298	2,345	2,302	2,253	2,143	1,975
20%	1,804	1,840	1,850	1,900	2,000	2,100	2,255	2,276	2,193	2,055	1,920	1,822
30%	1,576	1,594	1,740	1,816	1,981	2,091	2,222	2,159	2,074	1,924	1,793	1,645
40%	1,391	1,446	1,568	1,705	1,855	2,019	2,131	2,030	1,918	1,767	1,582	1,426
50%	1,267	1,266	1,396	1,567	1,685	1,818	2,012	1,912	1,773	1,601	1,416	1,304
60%	1,174	1,201	1,230	1,335	1,535	1,709	1,778	1,749	1,677	1,497	1,330	1,218
70%	1,106	1,099	1,179	1,216	1,362	1,484	1,645	1,599	1,537	1,400	1,225	1,111
80%	948	954	983	1,052	1,132	1,274	1,453	1,434	1,338	1,168	1,055	976
90%	634	645	672	724	810	921	1,051	975	917	802	689	651
Long Term												
Full Simulation Period ^b	1,269	1,288	1,352	1,431	1,554	1,678	1,819	1,796	1,727	1,583	1,434	1,319
Water Year Types^c												
Wet (32%)	1,501	1,535	1,644	1,767	1,931	2,055	2,224	2,250	2,194	2,068	1,939	1,805
Above Normal (16%)	1,208	1,245	1,363	1,524	1,718	1,901	2,079	2,053	1,955	1,815	1,647	1,513
Below Normal (13%)	1,451	1,472	1,492	1,554	1,641	1,729	1,872	1,799	1,696	1,515	1,337	1,204
Dry (24%)	1,178	1,184	1,210	1,230	1,322	1,453	1,586	1,536	1,466	1,302	1,152	1,055
Critical (15%)	819	803	813	825	868	949	999	962	929	811	667	598

Alternative 5

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,850	1,828	1,850	1,900	2,000	2,100	2,283	2,344	2,306	2,262	2,143	1,932
20%	1,764	1,735	1,803	1,889	2,000	2,100	2,250	2,276	2,207	2,064	1,893	1,743
30%	1,542	1,577	1,694	1,779	1,954	2,084	2,220	2,159	2,055	1,913	1,776	1,631
40%	1,427	1,373	1,560	1,683	1,770	1,994	2,131	2,029	1,921	1,779	1,600	1,453
50%	1,231	1,253	1,376	1,518	1,671	1,771	1,895	1,842	1,728	1,563	1,420	1,309
60%	1,127	1,172	1,247	1,279	1,493	1,669	1,798	1,720	1,634	1,479	1,271	1,148
70%	1,051	1,037	1,098	1,146	1,250	1,378	1,484	1,460	1,390	1,268	1,139	1,067
80%	834	850	879	977	1,036	1,141	1,321	1,259	1,209	1,066	941	830
90%	537	589	594	628	733	908	983	967	922	811	607	553
Long Term												
Full Simulation Period ^b	1,235	1,244	1,309	1,387	1,512	1,638	1,779	1,756	1,688	1,553	1,411	1,288
Water Year Types^c												
Wet (32%)	1,494	1,520	1,635	1,759	1,926	2,056	2,222	2,246	2,191	2,068	1,940	1,781
Above Normal (16%)	1,155	1,180	1,290	1,459	1,662	1,850	2,030	2,004	1,912	1,778	1,627	1,503
Below Normal (13%)	1,398	1,405	1,422	1,493	1,580	1,667	1,813	1,741	1,637	1,474	1,311	1,190
Dry (24%)	1,155	1,150	1,175	1,183	1,275	1,404	1,540	1,492	1,415	1,259	1,110	1,012
Critical (15%)	744	726	741	743	784	866	913	878	856	755	622	539

Alternative 5 minus Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	-22	0	0	0	0	-15	-1	4	10	1	-43
20%	-40	-105	-47	-11	0	0	-4	0	14	9	-27	-79
30%	-34	-17	-47	-36	-28	-6	-2	0	-18	-12	-17	-15
40%	37	-73	-9	-22	-85	-25	-1	-1	4	13	18	27
50%	-36	-13	-21	-49	-14	-47	-117	-70	-46	-38	4	4
60%	-48	-30	17	-56	-43	-40	19	-29	-44	-18	-59	-70
70%	-56	-62	-81	-70	-112	-105	-161	-139	-147	-132	-86	-44
80%	-114	-104	-104	-75	-96	-133	-131	-175	-129	-103	-114	-147
90%	-97	-56	-78	-96	-78	-13	-68	-8	5	10	-82	-99
Long Term												
Full Simulation Period ^b	-34	-44	-43	-45	-43	-40	-40	-40	-39	-30	-23	-30
Water Year Types^c												
Wet (32%)	-7	-16	-9	-8	-5	1	-2	-3	-3	0	1	-23
Above Normal (16%)	-53	-65	-73	-65	-56	-51	-49	-49	-43	-37	-20	-11
Below Normal (13%)	-54	-67	-69	-61	-62	-62	-59	-58	-60	-40	-26	-14
Dry (24%)	-23	-35	-35	-48	-47	-48	-46	-45	-51	-42	-42	-43
Critical (15%)	-75	-77	-72	-82	-84	-84	-86	-84	-73	-56	-45	-59

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 **C.2. Shasta Storage**

Figure C-2-1. Shasta Lake, End of April Storage

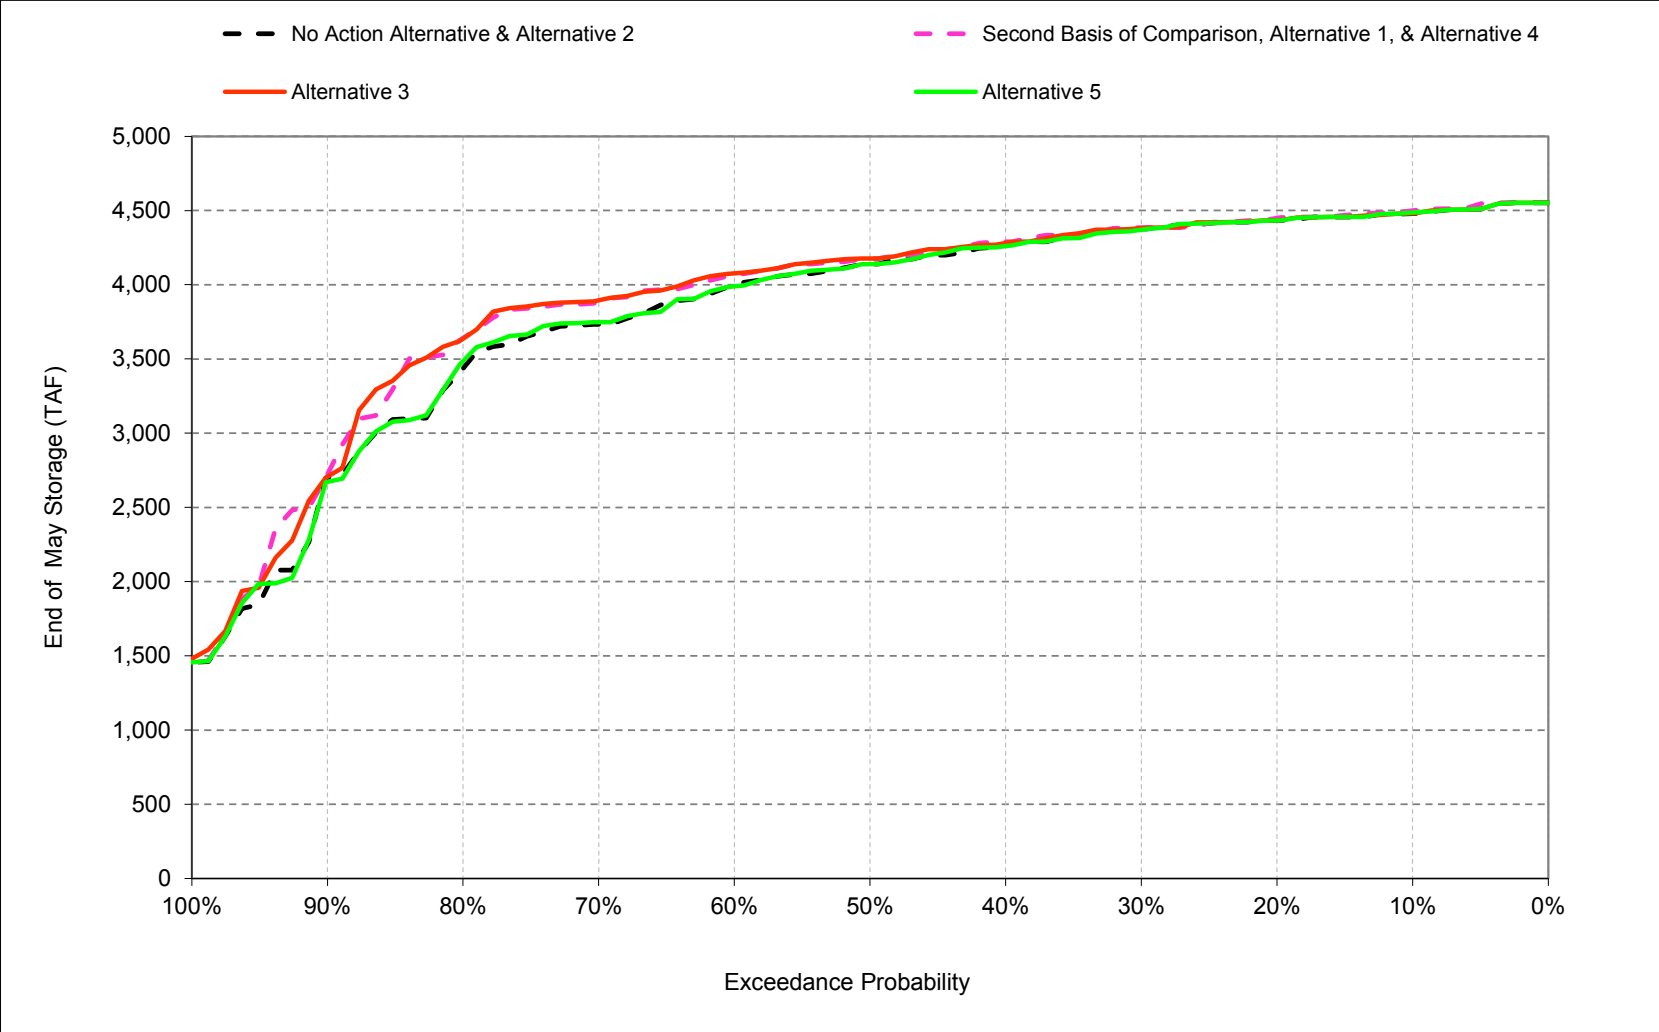


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-2-2. Shasta Lake, End of May Storage

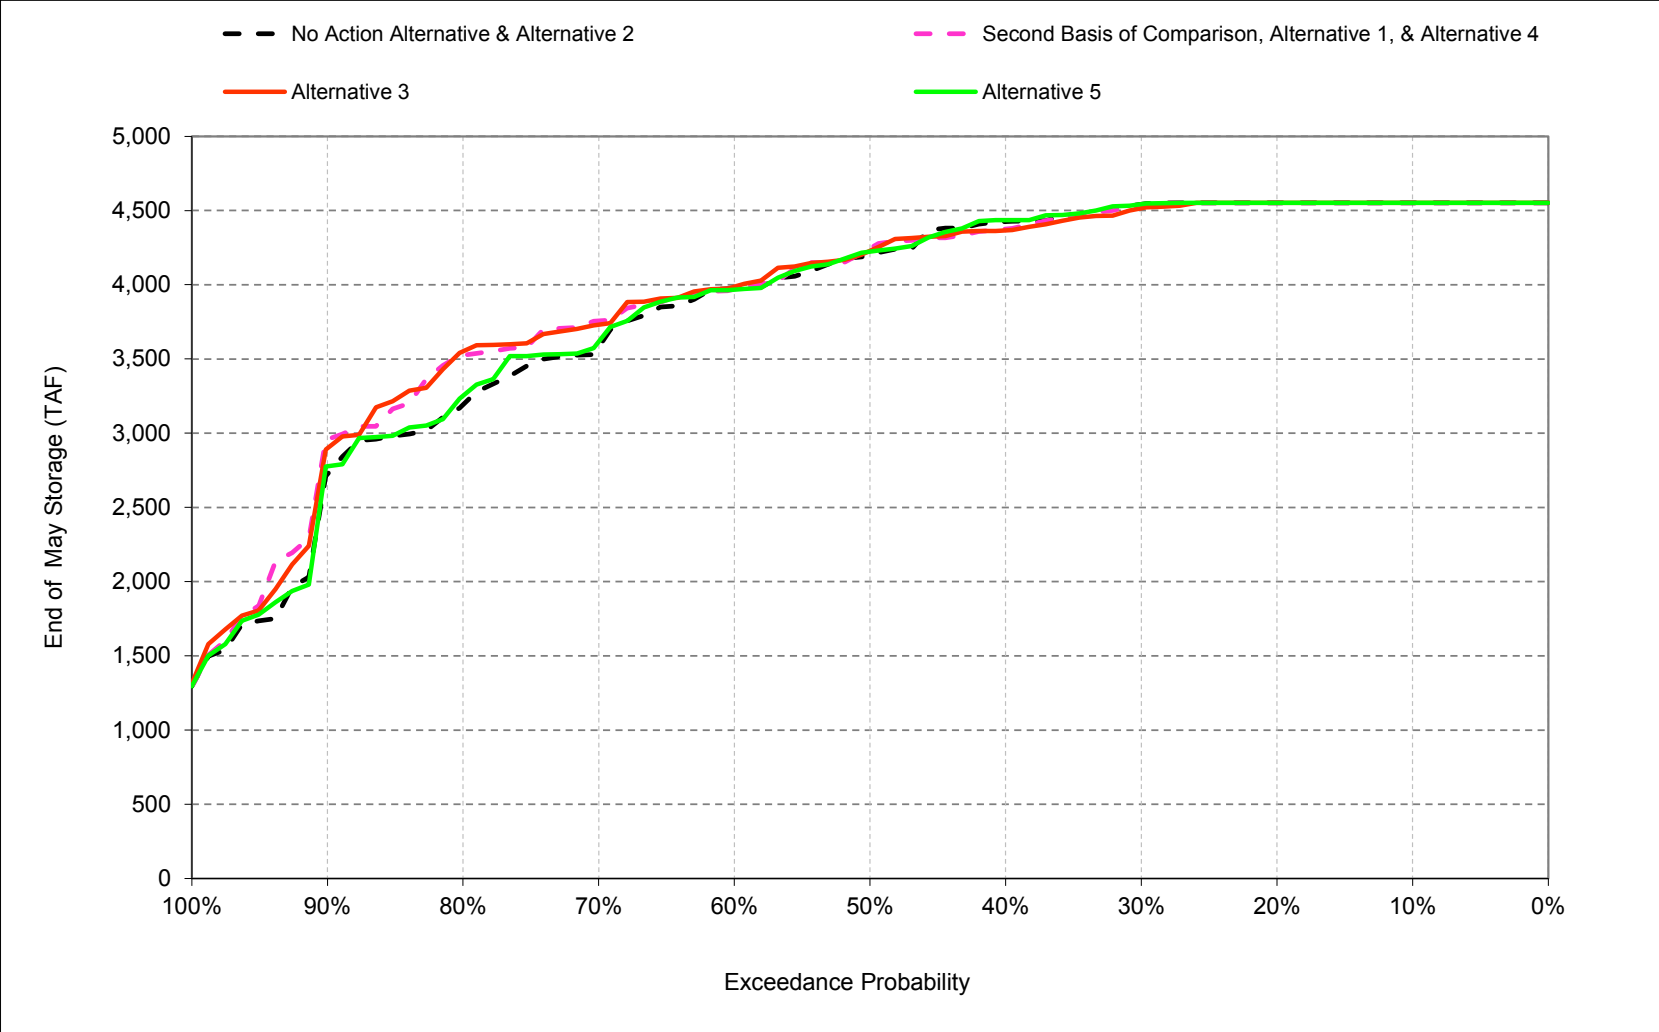

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-2-3. Shasta Lake, End of September Storage

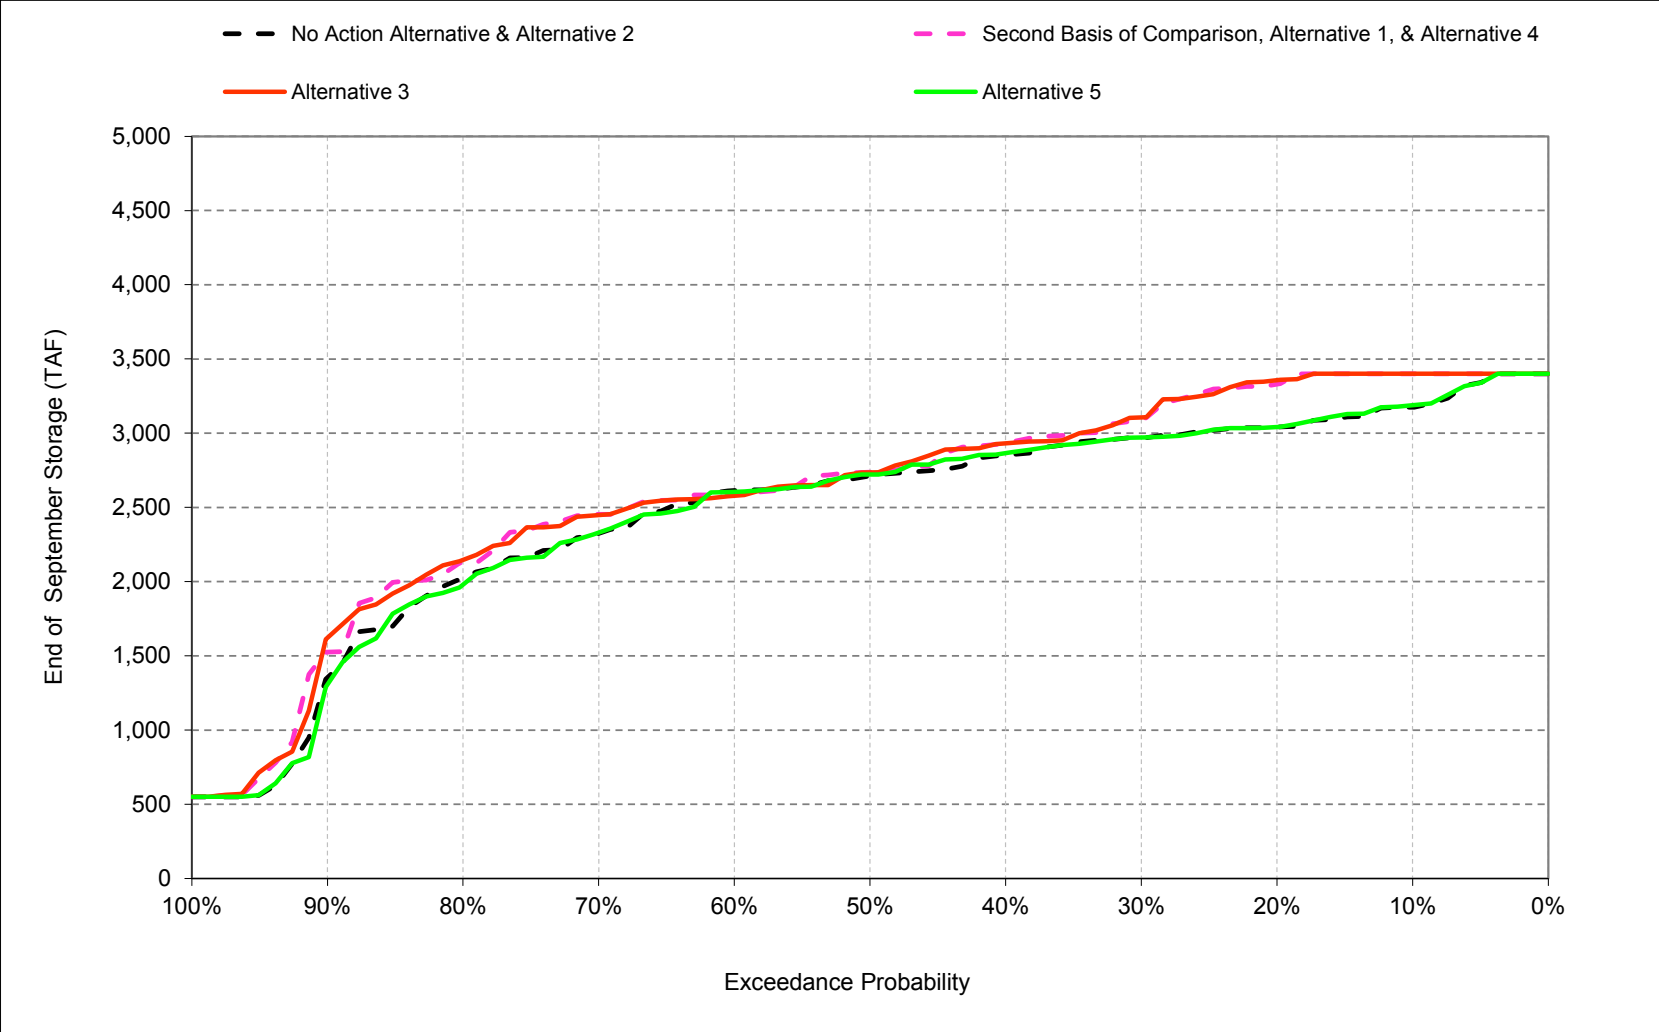

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-2-1. Shasta Lake, End of Month Storage

No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,200	3,209	3,322	3,615	3,812	4,217	4,479	4,552	4,452	3,904	3,575	3,176
20%	2,984	2,938	3,289	3,525	3,700	4,114	4,434	4,552	4,282	3,782	3,479	3,041
30%	2,854	2,759	3,252	3,375	3,616	3,998	4,376	4,542	4,196	3,577	3,227	2,970
40%	2,712	2,674	3,020	3,260	3,489	3,948	4,267	4,425	4,008	3,323	3,024	2,852
50%	2,586	2,531	2,759	3,156	3,388	3,764	4,139	4,202	3,774	3,178	2,841	2,713
60%	2,498	2,449	2,542	2,963	3,284	3,576	3,998	3,977	3,553	2,988	2,712	2,614
70%	2,234	2,251	2,345	2,625	3,145	3,422	3,733	3,580	3,299	2,701	2,491	2,324
80%	1,947	1,951	2,151	2,450	2,777	3,139	3,435	3,191	2,815	2,325	2,098	2,025
90%	1,261	1,240	1,336	1,964	2,191	2,552	2,701	2,725	2,357	1,781	1,402	1,354
Long Term												
Full Simulation Period ^b	2,400	2,378	2,591	2,899	3,185	3,553	3,835	3,847	3,519	2,986	2,676	2,483
Water Year Types^c												
Wet (32%)	2,700	2,719	3,077	3,384	3,589	3,836	4,298	4,460	4,242	3,735	3,410	2,985
Above Normal (16%)	2,369	2,385	2,600	3,167	3,453	4,021	4,404	4,429	4,039	3,407	3,069	2,834
Below Normal (13%)	2,587	2,548	2,686	3,062	3,442	3,814	4,026	3,957	3,588	3,002	2,643	2,608
Dry (24%)	2,345	2,283	2,428	2,621	3,034	3,505	3,737	3,668	3,284	2,767	2,496	2,462
Critical (15%)	1,702	1,633	1,717	1,871	2,031	2,274	2,202	2,088	1,719	1,253	986	937

Alternative 1												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,250	3,252	3,359	3,632	3,911	4,222	4,499	4,552	4,434	3,902	3,563	3,400
20%	3,247	3,252	3,333	3,552	3,771	4,118	4,448	4,552	4,283	3,767	3,380	3,330
30%	3,127	3,199	3,304	3,513	3,673	4,018	4,384	4,532	4,155	3,546	3,174	3,096
40%	2,924	3,028	3,254	3,382	3,569	3,978	4,290	4,375	3,913	3,291	2,980	2,935
50%	2,689	2,753	3,134	3,314	3,487	3,916	4,175	4,245	3,712	3,139	2,781	2,738
60%	2,520	2,594	2,922	3,170	3,354	3,727	4,064	3,971	3,493	2,942	2,636	2,592
70%	2,345	2,467	2,643	2,891	3,252	3,513	3,886	3,757	3,332	2,790	2,527	2,453
80%	2,099	2,145	2,178	2,609	2,978	3,409	3,640	3,525	2,951	2,410	2,127	2,125
90%	1,414	1,350	1,524	2,050	2,383	2,760	2,722	2,958	2,604	1,986	1,584	1,526
Long Term												
Full Simulation Period ^b	2,530	2,578	2,753	3,020	3,285	3,639	3,913	3,907	3,539	3,007	2,674	2,607
Water Year Types^c												
Wet (32%)	2,817	2,926	3,154	3,406	3,597	3,841	4,301	4,453	4,228	3,733	3,362	3,252
Above Normal (16%)	2,499	2,578	2,808	3,313	3,515	4,038	4,416	4,417	3,979	3,347	2,975	2,921
Below Normal (13%)	2,826	2,846	2,977	3,299	3,646	3,966	4,164	4,042	3,599	3,010	2,601	2,574
Dry (24%)	2,409	2,431	2,578	2,755	3,168	3,644	3,861	3,774	3,333	2,800	2,539	2,496
Critical (15%)	1,873	1,826	1,911	2,050	2,222	2,460	2,386	2,270	1,861	1,409	1,151	1,086

Alternative 1 minus No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	50	43	37	17	99	5	20	0	-18	-1	-12	224
20%	263	314	43	27	71	3	15	0	1	-15	-99	289
30%	273	440	52	138	57	20	9	-11	-42	-31	-53	126
40%	211	355	234	122	80	30	22	-50	-95	-32	-44	83
50%	103	222	375	158	99	151	36	43	-62	-39	-60	25
60%	23	144	380	207	69	150	67	-6	-60	-46	-76	-22
70%	111	217	297	266	107	91	153	177	33	88	37	129
80%	152	193	28	159	201	271	206	335	136	85	29	99
90%	153	110	188	85	193	208	20	234	246	205	182	172
Long Term												
Full Simulation Period ^b	131	201	162	121	100	86	78	60	20	22	-2	124
Water Year Types^c												
Wet (32%)	117	208	77	22	8	5	3	-7	-14	-2	-49	267
Above Normal (16%)	130	193	208	146	62	17	12	-11	-60	-60	-94	87
Below Normal (13%)	239	298	291	237	204	152	138	86	10	8	-42	-33
Dry (24%)	64	148	150	135	134	139	123	106	48	33	42	35
Critical (15%)	171	193	194	179	190	186	184	183	142	155	165	149

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-2-2. Shasta Lake, End of Month Storage

No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,200	3,209	3,322	3,615	3,812	4,217	4,479	4,552	4,452	3,904	3,575	3,176
20%	2,984	2,938	3,289	3,525	3,700	4,114	4,434	4,552	4,282	3,782	3,479	3,041
30%	2,854	2,759	3,252	3,375	3,616	3,998	4,376	4,542	4,196	3,577	3,227	2,970
40%	2,712	2,674	3,020	3,260	3,489	3,948	4,267	4,425	4,008	3,323	3,024	2,852
50%	2,586	2,531	2,759	3,156	3,388	3,764	4,139	4,202	3,774	3,178	2,841	2,713
60%	2,498	2,449	2,542	2,963	3,284	3,576	3,998	3,977	3,553	2,988	2,712	2,614
70%	2,234	2,251	2,345	2,625	3,145	3,422	3,733	3,580	3,299	2,701	2,491	2,324
80%	1,947	1,951	2,151	2,450	2,777	3,139	3,435	3,191	2,815	2,325	2,098	2,025
90%	1,261	1,240	1,336	1,964	2,191	2,552	2,701	2,725	2,357	1,781	1,402	1,354
Long Term												
Full Simulation Period ^b	2,400	2,378	2,591	2,899	3,185	3,553	3,835	3,847	3,519	2,986	2,676	2,483
Water Year Types^c												
Wet (32%)	2,700	2,719	3,077	3,384	3,589	3,836	4,298	4,460	4,242	3,735	3,410	2,985
Above Normal (16%)	2,369	2,385	2,600	3,167	3,453	4,021	4,404	4,429	4,039	3,407	3,069	2,834
Below Normal (13%)	2,587	2,548	2,686	3,062	3,442	3,814	4,026	3,957	3,588	3,002	2,643	2,608
Dry (24%)	2,345	2,283	2,428	2,621	3,034	3,505	3,737	3,668	3,284	2,767	2,496	2,462
Critical (15%)	1,702	1,633	1,717	1,871	2,031	2,274	2,202	2,088	1,719	1,253	986	937

Alternative 3												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,250	3,252	3,349	3,639	3,910	4,225	4,481	4,552	4,434	3,884	3,579	3,400
20%	3,200	3,251	3,321	3,552	3,771	4,127	4,435	4,552	4,276	3,764	3,421	3,358
30%	3,094	3,161	3,292	3,513	3,675	4,020	4,382	4,515	4,155	3,528	3,171	3,106
40%	2,918	3,066	3,257	3,370	3,592	3,975	4,281	4,367	3,917	3,296	2,999	2,933
50%	2,680	2,774	3,085	3,277	3,484	3,866	4,177	4,228	3,736	3,148	2,761	2,735
60%	2,475	2,593	2,921	3,173	3,330	3,751	4,078	3,987	3,504	2,992	2,668	2,579
70%	2,379	2,412	2,634	2,889	3,252	3,513	3,895	3,731	3,375	2,802	2,547	2,448
80%	2,107	2,114	2,239	2,610	2,981	3,387	3,636	3,552	2,996	2,475	2,188	2,146
90%	1,527	1,514	1,581	2,107	2,371	2,814	2,706	2,899	2,628	2,089	1,752	1,621
Long Term												
Full Simulation Period ^b	2,525	2,578	2,750	3,019	3,284	3,636	3,914	3,908	3,543	3,013	2,687	2,605
Water Year Types^c												
Wet (32%)	2,816	2,932	3,161	3,408	3,597	3,841	4,301	4,453	4,221	3,720	3,370	3,244
Above Normal (16%)	2,475	2,555	2,783	3,303	3,509	4,023	4,403	4,401	3,975	3,350	2,998	2,946
Below Normal (13%)	2,818	2,851	2,983	3,302	3,650	3,971	4,176	4,056	3,631	3,036	2,669	2,562
Dry (24%)	2,431	2,451	2,590	2,770	3,189	3,662	3,885	3,798	3,359	2,826	2,542	2,500
Critical (15%)	1,833	1,793	1,877	2,024	2,184	2,424	2,354	2,237	1,836	1,406	1,129	1,066

Alternative 3 minus No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	50	43	27	25	98	8	2	0	-18	-20	4	224
20%	216	313	32	26	71	13	1	0	-7	-17	-58	316
30%	240	402	40	138	59	22	6	-27	-41	-48	-56	136
40%	206	392	237	110	104	27	14	-59	-91	-27	-26	80
50%	94	244	326	122	96	101	39	26	-38	-29	-80	23
60%	-23	143	379	209	46	175	80	11	-49	4	-44	-35
70%	145	162	289	264	107	91	163	151	76	101	56	124
80%	160	163	89	160	204	248	201	361	181	150	90	120
90%	266	274	245	143	180	263	5	174	271	308	351	267
Long Term												
Full Simulation Period ^b	125	200	158	120	99	83	79	60	24	27	11	122
Water Year Types^c												
Wet (32%)	116	214	84	24	8	5	2	-7	-21	-16	-41	260
Above Normal (16%)	106	170	183	136	56	2	-1	-27	-64	-57	-71	112
Below Normal (13%)	231	302	296	240	208	157	150	99	42	34	26	-46
Dry (24%)	86	168	162	149	155	156	148	130	74	58	45	38
Critical (15%)	131	160	160	153	152	149	152	149	117	153	143	129

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-2-3. Shasta Lake, End of Month Storage

No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,200	3,209	3,322	3,615	3,812	4,217	4,479	4,552	4,452	3,904	3,575	3,176
20%	2,984	2,938	3,289	3,525	3,700	4,114	4,434	4,552	4,282	3,782	3,479	3,041
30%	2,854	2,759	3,252	3,375	3,616	3,998	4,376	4,542	4,196	3,577	3,227	2,970
40%	2,712	2,674	3,020	3,260	3,489	3,948	4,267	4,425	4,008	3,323	3,024	2,852
50%	2,586	2,531	2,759	3,156	3,388	3,764	4,139	4,202	3,774	3,178	2,841	2,713
60%	2,498	2,449	2,542	2,963	3,284	3,576	3,998	3,977	3,553	2,988	2,712	2,614
70%	2,234	2,251	2,345	2,625	3,145	3,422	3,733	3,580	3,299	2,701	2,491	2,324
80%	1,947	1,951	2,151	2,450	2,777	3,139	3,435	3,191	2,815	2,325	2,098	2,025
90%	1,261	1,240	1,336	1,964	2,191	2,552	2,701	2,725	2,357	1,781	1,402	1,354
Long Term												
Full Simulation Period ^b	2,400	2,378	2,591	2,899	3,185	3,553	3,835	3,847	3,519	2,986	2,676	2,483
Water Year Types^c												
Wet (32%)	2,700	2,719	3,077	3,384	3,589	3,836	4,298	4,460	4,242	3,735	3,410	2,985
Above Normal (16%)	2,369	2,385	2,600	3,167	3,453	4,021	4,404	4,429	4,039	3,407	3,069	2,834
Below Normal (13%)	2,587	2,548	2,686	3,062	3,442	3,814	4,026	3,957	3,588	3,002	2,643	2,608
Dry (24%)	2,345	2,283	2,428	2,621	3,034	3,505	3,737	3,668	3,284	2,767	2,496	2,462
Critical (15%)	1,702	1,633	1,717	1,871	2,031	2,274	2,202	2,088	1,719	1,253	986	937

Alternative 5												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,200	3,242	3,322	3,615	3,812	4,217	4,486	4,552	4,451	3,905	3,580	3,188
20%	3,018	2,911	3,293	3,525	3,704	4,114	4,434	4,552	4,282	3,762	3,471	3,041
30%	2,878	2,770	3,252	3,370	3,616	3,998	4,371	4,542	4,196	3,578	3,239	2,971
40%	2,735	2,684	3,037	3,270	3,496	3,944	4,260	4,435	3,973	3,313	3,027	2,866
50%	2,615	2,540	2,771	3,188	3,391	3,756	4,139	4,223	3,785	3,196	2,859	2,722
60%	2,495	2,452	2,537	2,971	3,284	3,590	3,989	3,967	3,595	3,020	2,738	2,605
70%	2,246	2,250	2,355	2,639	3,163	3,417	3,748	3,615	3,292	2,728	2,489	2,330
80%	1,912	1,958	2,146	2,447	2,766	3,151	3,485	3,251	2,855	2,356	2,051	1,979
90%	1,216	1,196	1,281	1,929	2,246	2,565	2,672	2,777	2,423	1,794	1,341	1,308
Long Term												
Full Simulation Period ^b	2,399	2,377	2,593	2,900	3,185	3,552	3,838	3,859	3,534	2,991	2,675	2,483
Water Year Types^c												
Wet (32%)	2,704	2,716	3,078	3,385	3,590	3,836	4,299	4,461	4,243	3,736	3,410	2,989
Above Normal (16%)	2,369	2,388	2,598	3,164	3,454	4,019	4,401	4,430	4,042	3,409	3,071	2,842
Below Normal (13%)	2,603	2,565	2,704	3,077	3,450	3,820	4,039	3,970	3,602	3,012	2,663	2,620
Dry (24%)	2,344	2,287	2,433	2,627	3,039	3,509	3,745	3,699	3,315	2,787	2,497	2,459
Critical (15%)	1,676	1,611	1,700	1,856	2,015	2,258	2,203	2,104	1,749	1,246	958	910

Alternative 5 minus No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	33	0	0	0	0	7	0	-1	1	5	12
20%	34	-27	3	0	4	0	0	0	0	-20	-9	0
30%	24	11	0	-5	0	0	-5	0	0	1	12	1
40%	22	11	17	10	7	-4	-7	10	-35	-10	3	14
50%	29	9	12	33	2	-8	0	20	11	19	19	9
60%	-2	3	-5	7	0	14	-8	-10	43	32	26	-8
70%	12	-1	10	14	18	-5	15	35	-7	27	-2	6
80%	-35	7	-4	-3	-11	12	50	60	40	30	-47	-46
90%	-45	-44	-55	-35	55	13	-30	53	66	13	-61	-47
Long Term												
Full Simulation Period ^b	-1	0	1	1	0	-1	3	12	15	5	-1	0
Water Year Types^c												
Wet (32%)	4	-3	1	1	0	0	1	1	1	0	0	4
Above Normal (16%)	0	4	-2	-3	0	-1	-3	2	3	2	2	8
Below Normal (13%)	16	16	18	16	8	6	13	13	14	10	20	12
Dry (24%)	-1	4	5	6	5	4	8	31	31	20	1	-3
Critical (15%)	-25	-22	-17	-15	-16	-16	1	16	31	-7	-28	-26

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-2-4. Shasta Lake, End of Month Storage

Second Basis of Comparison		End of Month Storage (TAF)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,250	3,252	3,359	3,632	3,911	4,222	4,499	4,552	4,434	3,902	3,563	3,400
20%	3,247	3,252	3,333	3,552	3,771	4,118	4,448	4,552	4,283	3,767	3,380	3,330
30%	3,127	3,199	3,304	3,513	3,673	4,018	4,384	4,532	4,155	3,546	3,174	3,096
40%	2,924	3,028	3,254	3,382	3,569	3,978	4,290	4,375	3,913	3,291	2,980	2,935
50%	2,689	2,753	3,134	3,314	3,487	3,916	4,175	4,245	3,712	3,139	2,781	2,738
60%	2,520	2,594	2,922	3,170	3,354	3,727	4,064	3,971	3,493	2,942	2,636	2,592
70%	2,345	2,467	2,643	2,891	3,252	3,513	3,886	3,757	3,332	2,790	2,527	2,453
80%	2,099	2,145	2,178	2,609	2,978	3,409	3,640	3,525	2,951	2,410	2,127	2,125
90%	1,414	1,350	1,524	2,050	2,383	2,760	2,722	2,958	2,604	1,986	1,584	1,526
Long Term												
Full Simulation Period ^b	2,530	2,578	2,753	3,020	3,285	3,639	3,913	3,907	3,539	3,007	2,674	2,607
Water Year Types^c												
Wet (32%)	2,817	2,926	3,154	3,406	3,597	3,841	4,301	4,453	4,228	3,733	3,362	3,252
Above Normal (16%)	2,499	2,578	2,808	3,313	3,515	4,038	4,416	4,417	3,979	3,347	2,975	2,921
Below Normal (13%)	2,826	2,846	2,977	3,299	3,646	3,966	4,164	4,042	3,599	3,010	2,601	2,574
Dry (24%)	2,409	2,431	2,578	2,755	3,168	3,644	3,861	3,774	3,333	2,800	2,539	2,496
Critical (15%)	1,873	1,826	1,911	2,050	2,222	2,460	2,386	2,270	1,861	1,409	1,151	1,086

No Action Alternative		End of Month Storage (TAF)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,200	3,209	3,322	3,615	3,812	4,217	4,479	4,552	4,452	3,904	3,575	3,176
20%	2,984	2,938	3,289	3,525	3,700	4,114	4,434	4,552	4,282	3,782	3,479	3,041
30%	2,854	2,759	3,252	3,375	3,616	3,998	4,376	4,542	4,196	3,577	3,227	2,970
40%	2,712	2,674	3,020	3,260	3,489	3,948	4,267	4,425	4,008	3,323	3,024	2,852
50%	2,586	2,531	2,759	3,156	3,388	3,764	4,139	4,202	3,774	3,178	2,841	2,713
60%	2,498	2,449	2,542	2,963	3,284	3,576	3,998	3,977	3,553	2,988	2,712	2,614
70%	2,234	2,251	2,345	2,625	3,145	3,422	3,733	3,580	3,299	2,701	2,491	2,324
80%	1,947	1,951	2,151	2,450	2,777	3,139	3,435	3,191	2,815	2,325	2,098	2,025
90%	1,261	1,240	1,336	1,964	2,191	2,552	2,701	2,725	2,357	1,781	1,402	1,354
Long Term												
Full Simulation Period ^b	2,400	2,378	2,591	2,899	3,185	3,553	3,835	3,847	3,519	2,986	2,676	2,483
Water Year Types^c												
Wet (32%)	2,700	2,719	3,077	3,384	3,589	3,836	4,298	4,460	4,242	3,735	3,410	2,985
Above Normal (16%)	2,369	2,385	2,600	3,167	3,453	4,021	4,404	4,429	4,039	3,407	3,069	2,834
Below Normal (13%)	2,587	2,548	2,686	3,062	3,442	3,814	4,026	3,957	3,588	3,002	2,643	2,608
Dry (24%)	2,345	2,283	2,428	2,621	3,034	3,505	3,737	3,668	3,284	2,767	2,496	2,462
Critical (15%)	1,702	1,633	1,717	1,871	2,031	2,274	2,202	2,088	1,719	1,253	986	937

No Action Alternative minus Second Basis of Comparison		End of Month Storage (TAF)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-50	-43	-37	-17	-99	-5	-20	0	18	1	12	-224
20%	-263	-314	-43	-27	-71	-3	-15	0	-1	15	99	-289
30%	-273	-440	-52	-138	-57	-20	-9	11	42	31	53	-126
40%	-211	-355	-234	-122	-80	-30	-22	50	95	32	44	-83
50%	-103	-222	-375	-158	-99	-151	-36	-43	62	39	60	-25
60%	-23	-144	-380	-207	-69	-150	-67	6	60	46	76	22
70%	-111	-217	-297	-266	-107	-91	-153	-177	-33	-88	-37	-129
80%	-152	-193	-28	-159	-201	-271	-206	-335	-136	-85	-29	-99
90%	-153	-110	-188	-85	-193	-208	-20	-234	-246	-205	-182	-172
Long Term												
Full Simulation Period ^b	-131	-201	-162	-121	-100	-86	-78	-60	-20	-22	2	-124
Water Year Types^c												
Wet (32%)	-117	-208	-77	-22	-8	-5	-3	7	14	2	49	-267
Above Normal (16%)	-130	-193	-208	-146	-62	-17	-12	11	60	60	94	-87
Below Normal (13%)	-239	-298	-291	-237	-204	-152	-138	-86	-10	-8	42	33
Dry (24%)	-64	-148	-150	-135	-134	-139	-123	-106	-48	-33	-42	-35
Critical (15%)	-171	-193	-194	-179	-190	-186	-184	-183	-142	-155	-165	-149

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-2-5. Shasta Lake, End of Month Storage

Second Basis of Comparison												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,250	3,252	3,359	3,632	3,911	4,222	4,499	4,552	4,434	3,902	3,563	3,400
20%	3,247	3,252	3,333	3,552	3,771	4,118	4,448	4,552	4,283	3,767	3,380	3,330
30%	3,127	3,199	3,304	3,513	3,673	4,018	4,384	4,532	4,155	3,546	3,174	3,096
40%	2,924	3,028	3,254	3,382	3,569	3,978	4,290	4,375	3,913	3,291	2,980	2,935
50%	2,689	2,753	3,134	3,314	3,487	3,916	4,175	4,245	3,712	3,139	2,781	2,738
60%	2,520	2,594	2,922	3,170	3,354	3,727	4,064	3,971	3,493	2,942	2,636	2,592
70%	2,345	2,467	2,643	2,891	3,252	3,513	3,886	3,757	3,332	2,790	2,527	2,453
80%	2,099	2,145	2,178	2,609	2,978	3,409	3,640	3,525	2,951	2,410	2,127	2,125
90%	1,414	1,350	1,524	2,050	2,383	2,760	2,722	2,958	2,604	1,986	1,584	1,526
Long Term												
Full Simulation Period ^b	2,530	2,578	2,753	3,020	3,285	3,639	3,913	3,907	3,539	3,007	2,674	2,607
Water Year Types^c												
Wet (32%)	2,817	2,926	3,154	3,406	3,597	3,841	4,301	4,453	4,228	3,733	3,362	3,252
Above Normal (16%)	2,499	2,578	2,808	3,313	3,515	4,038	4,416	4,417	3,979	3,347	2,975	2,921
Below Normal (13%)	2,826	2,846	2,977	3,299	3,646	3,966	4,164	4,042	3,599	3,010	2,601	2,574
Dry (24%)	2,409	2,431	2,578	2,755	3,168	3,644	3,861	3,774	3,333	2,800	2,539	2,496
Critical (15%)	1,873	1,826	1,911	2,050	2,222	2,460	2,386	2,270	1,861	1,409	1,151	1,086

Alternative 3												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,250	3,252	3,349	3,639	3,910	4,225	4,481	4,552	4,434	3,884	3,579	3,400
20%	3,200	3,251	3,321	3,552	3,771	4,127	4,435	4,552	4,276	3,764	3,421	3,358
30%	3,094	3,161	3,292	3,513	3,675	4,020	4,382	4,515	4,155	3,528	3,171	3,106
40%	2,918	3,066	3,257	3,370	3,592	3,975	4,281	4,367	3,917	3,296	2,999	2,933
50%	2,680	2,774	3,085	3,277	3,484	3,866	4,177	4,228	3,736	3,148	2,761	2,735
60%	2,475	2,593	2,921	3,173	3,330	3,751	4,078	3,987	3,504	2,992	2,668	2,579
70%	2,379	2,412	2,634	2,889	3,252	3,513	3,895	3,731	3,375	2,802	2,547	2,448
80%	2,107	2,114	2,239	2,610	2,981	3,387	3,636	3,552	2,996	2,475	2,188	2,146
90%	1,527	1,514	1,581	2,107	2,371	2,814	2,706	2,899	2,628	2,089	1,752	1,621
Long Term												
Full Simulation Period ^b	2,525	2,578	2,750	3,019	3,284	3,636	3,914	3,908	3,543	3,013	2,687	2,605
Water Year Types^c												
Wet (32%)	2,816	2,932	3,161	3,408	3,597	3,841	4,301	4,453	4,221	3,720	3,370	3,244
Above Normal (16%)	2,475	2,555	2,783	3,303	3,509	4,023	4,403	4,401	3,975	3,350	2,998	2,946
Below Normal (13%)	2,818	2,851	2,983	3,302	3,650	3,971	4,176	4,056	3,631	3,036	2,669	2,562
Dry (24%)	2,431	2,451	2,590	2,770	3,189	3,662	3,885	3,798	3,359	2,826	2,542	2,500
Critical (15%)	1,833	1,793	1,877	2,024	2,184	2,424	2,354	2,237	1,836	1,406	1,129	1,066

Alternative 3 minus Second Basis of Comparison												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	-10	7	-1	3	-17	0	0	-18	16	0
20%	-48	-1	-11	0	0	9	-14	0	-8	-3	41	27
30%	-34	-38	-11	0	2	2	-3	-16	0	-18	-3	10
40%	-5	37	3	-12	24	-3	-9	-8	4	4	18	-2
50%	-8	22	-49	-36	-3	-50	2	-17	24	9	-20	-2
60%	-46	-1	-1	3	-24	25	13	17	11	50	32	-13
70%	34	-55	-8	-2	0	0	10	-26	43	13	19	-5
80%	8	-31	61	1	3	-23	-5	26	45	65	61	21
90%	113	164	57	57	-13	54	-15	-59	25	103	168	95
Long Term												
Full Simulation Period ^b	-6	-1	-3	-1	-1	-3	1	0	4	6	13	-2
Water Year Types^c												
Wet (32%)	-1	6	7	2	0	0	0	0	-7	-13	8	-8
Above Normal (16%)	-24	-23	-25	-11	-6	-15	-13	-16	-4	3	23	25
Below Normal (13%)	-9	5	5	3	4	5	12	13	32	26	68	-13
Dry (24%)	22	21	12	15	22	17	24	24	26	25	3	4
Critical (15%)	-40	-33	-34	-26	-38	-36	-32	-33	-25	-2	-22	-20

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-2-6. Shasta Lake, End of Month Storage

Second Basis of Comparison												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,250	3,252	3,359	3,632	3,911	4,222	4,499	4,552	4,434	3,902	3,563	3,400
20%	3,247	3,252	3,333	3,552	3,771	4,118	4,448	4,552	4,283	3,767	3,380	3,330
30%	3,127	3,199	3,304	3,513	3,673	4,018	4,384	4,532	4,155	3,546	3,174	3,096
40%	2,924	3,028	3,254	3,382	3,569	3,978	4,290	4,375	3,913	3,291	2,980	2,935
50%	2,689	2,753	3,134	3,314	3,487	3,916	4,175	4,245	3,712	3,139	2,781	2,738
60%	2,520	2,594	2,922	3,170	3,354	3,727	4,064	3,971	3,493	2,942	2,636	2,592
70%	2,345	2,467	2,643	2,891	3,252	3,513	3,886	3,757	3,332	2,790	2,527	2,453
80%	2,099	2,145	2,178	2,609	2,978	3,409	3,640	3,525	2,951	2,410	2,127	2,125
90%	1,414	1,350	1,524	2,050	2,383	2,760	2,722	2,958	2,604	1,986	1,584	1,526
Long Term												
Full Simulation Period ^b	2,530	2,578	2,753	3,020	3,285	3,639	3,913	3,907	3,539	3,007	2,674	2,607
Water Year Types^c												
Wet (32%)	2,817	2,926	3,154	3,406	3,597	3,841	4,301	4,453	4,228	3,733	3,362	3,252
Above Normal (16%)	2,499	2,578	2,808	3,313	3,515	4,038	4,416	4,417	3,979	3,347	2,975	2,921
Below Normal (13%)	2,826	2,846	2,977	3,299	3,646	3,966	4,164	4,042	3,599	3,010	2,601	2,574
Dry (24%)	2,409	2,431	2,578	2,755	3,168	3,644	3,861	3,774	3,333	2,800	2,539	2,496
Critical (15%)	1,873	1,826	1,911	2,050	2,222	2,460	2,386	2,270	1,861	1,409	1,151	1,086

Alternative 5

End of Month Storage (TAF)												
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,200	3,242	3,322	3,615	3,812	4,217	4,486	4,552	4,451	3,905	3,580	3,188
20%	3,018	2,911	3,293	3,525	3,704	4,114	4,434	4,552	4,282	3,762	3,471	3,041
30%	2,878	2,770	3,252	3,370	3,616	3,998	4,371	4,542	4,196	3,578	3,239	2,971
40%	2,735	2,684	3,037	3,270	3,496	3,944	4,260	4,435	3,973	3,313	3,027	2,866
50%	2,615	2,540	2,771	3,188	3,391	3,756	4,139	4,223	3,785	3,196	2,859	2,722
60%	2,495	2,452	2,537	2,971	3,284	3,590	3,989	3,967	3,595	3,020	2,738	2,605
70%	2,246	2,250	2,355	2,639	3,163	3,417	3,748	3,615	3,292	2,728	2,489	2,330
80%	1,912	1,958	2,146	2,447	2,766	3,151	3,485	3,251	2,855	2,356	2,051	1,979
90%	1,216	1,196	1,281	1,929	2,246	2,565	2,672	2,777	2,423	1,794	1,341	1,308
Long Term												
Full Simulation Period ^b	2,399	2,377	2,593	2,900	3,185	3,552	3,838	3,859	3,534	2,991	2,675	2,483
Water Year Types^c												
Wet (32%)	2,704	2,716	3,078	3,385	3,590	3,836	4,299	4,461	4,243	3,736	3,410	2,989
Above Normal (16%)	2,369	2,388	2,598	3,164	3,454	4,019	4,401	4,430	4,042	3,409	3,071	2,842
Below Normal (13%)	2,603	2,565	2,704	3,077	3,450	3,820	4,039	3,970	3,602	3,012	2,663	2,620
Dry (24%)	2,344	2,287	2,433	2,627	3,039	3,509	3,745	3,699	3,315	2,787	2,497	2,459
Critical (15%)	1,676	1,611	1,700	1,856	2,015	2,258	2,203	2,104	1,749	1,246	958	910

Alternative 5 minus Second Basis of Comparison

End of Month Storage (TAF)												
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-50	-10	-37	-17	-99	-5	-12	0	17	3	17	-212
20%	-229	-341	-40	-27	-66	-3	-15	0	-1	-5	91	-289
30%	-250	-429	-52	-143	-57	-20	-14	11	42	32	66	-124
40%	-189	-344	-217	-112	-73	-34	-30	60	60	21	47	-69
50%	-73	-213	-363	-125	-96	-160	-36	-22	73	58	78	-15
60%	-25	-141	-385	-199	-69	-137	-75	-3	102	78	102	13
70%	-99	-218	-287	-252	-89	-96	-138	-142	-40	-61	-39	-124
80%	-187	-187	-32	-162	-212	-259	-156	-274	-96	-54	-76	-145
90%	-198	-154	-244	-121	-138	-195	-50	-181	-180	-192	-243	-218
Long Term												
Full Simulation Period ^b	-131	-201	-160	-120	-100	-87	-75	-48	-5	-16	1	-125
Water Year Types^c												
Wet (32%)	-114	-211	-76	-21	-8	-5	-2	7	15	3	48	-263
Above Normal (16%)	-130	-190	-210	-149	-62	-19	-15	13	63	62	97	-79
Below Normal (13%)	-224	-281	-273	-221	-196	-146	-125	-72	3	1	62	45
Dry (24%)	-64	-144	-145	-129	-129	-135	-116	-75	-18	-13	-41	-38
Critical (15%)	-197	-215	-211	-194	-207	-202	-183	-166	-111	-163	-193	-176

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 **C.3. Oroville Storage**

Figure C-3-1. Lake Oroville, End of May Storage

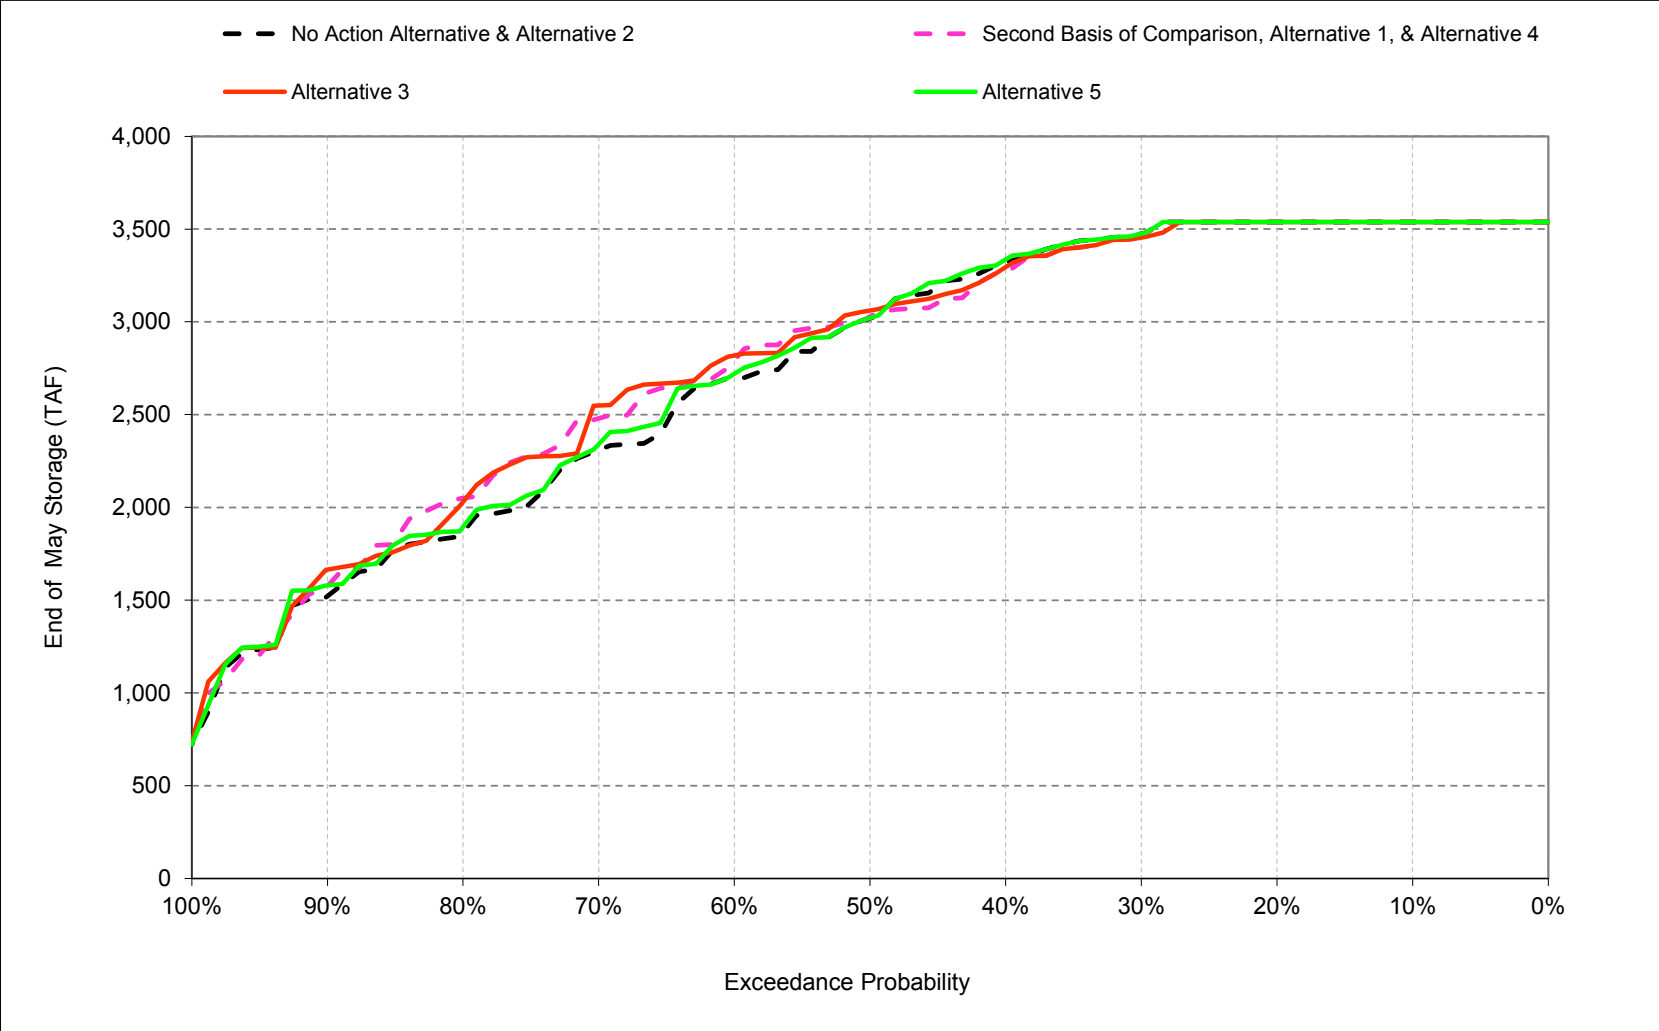

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-3-2. Lake Oroville, End of September Storage

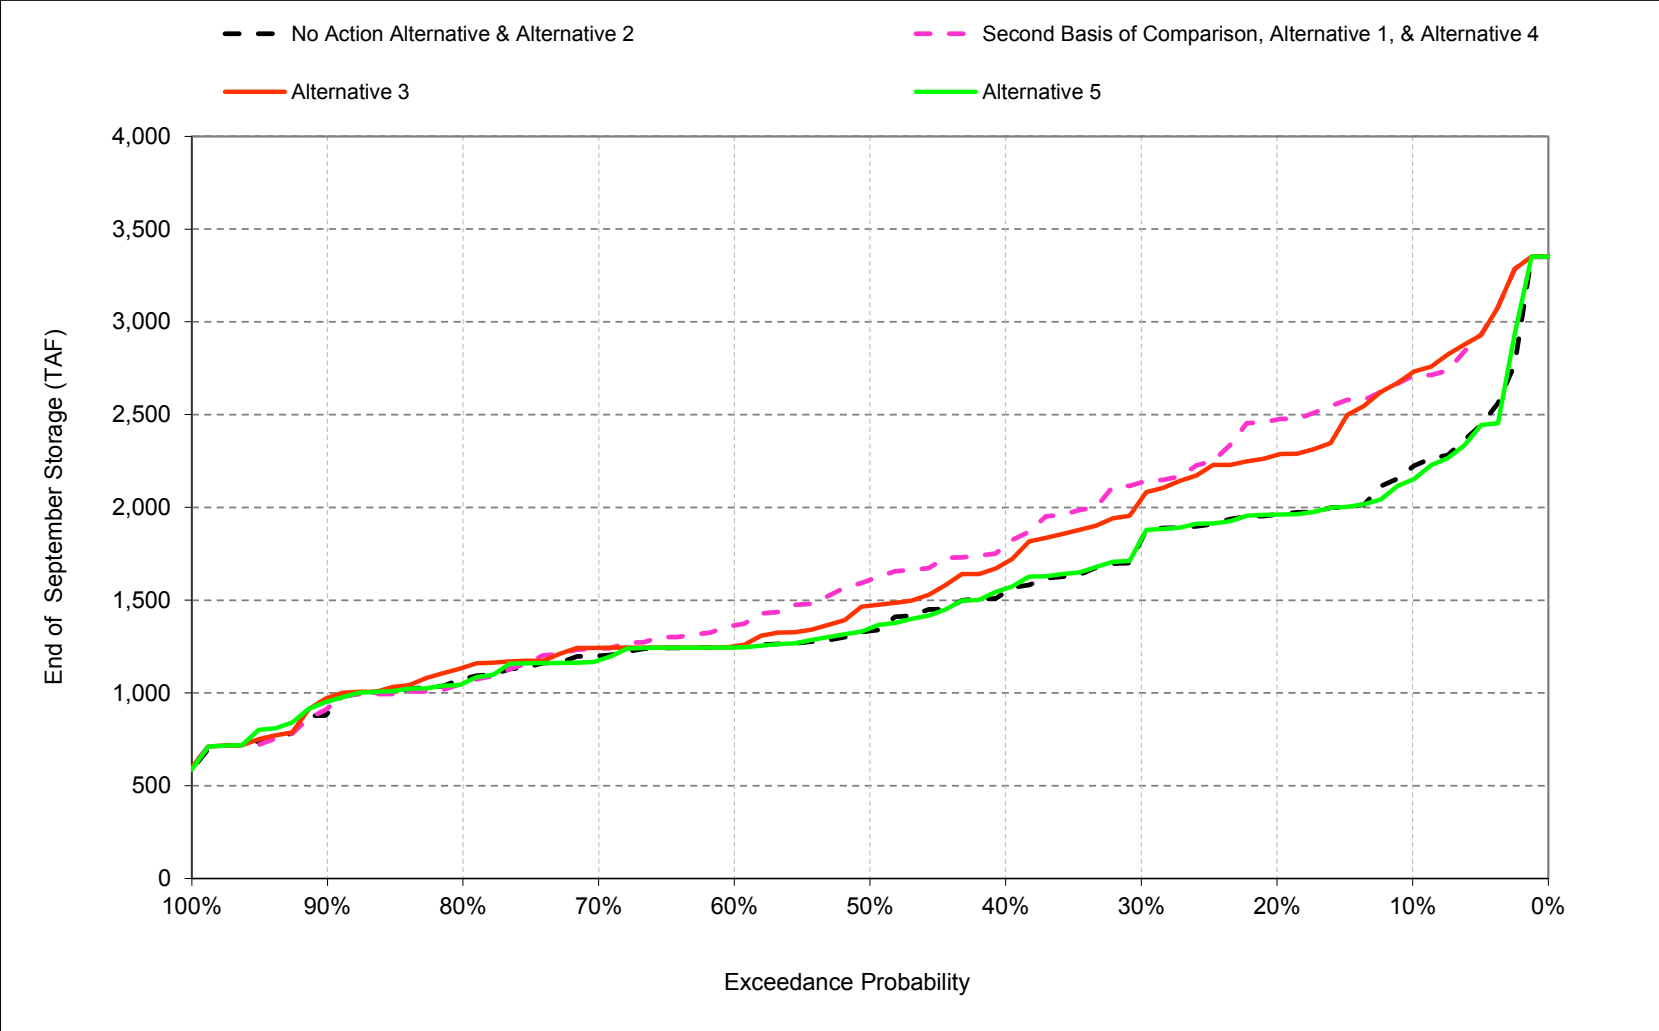

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-3-1. Lake Oroville, End of Month Storage

No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,052	2,115	2,719	2,788	2,918	3,035	3,352	3,538	3,538	3,037	2,759	2,218
20%	1,775	1,798	2,033	2,616	2,788	2,964	3,298	3,538	3,538	2,952	2,501	1,962
30%	1,617	1,660	1,802	2,290	2,788	2,898	3,268	3,475	3,361	2,747	2,311	1,824
40%	1,404	1,407	1,593	1,932	2,557	2,788	3,208	3,320	3,112	2,476	1,962	1,544
50%	1,248	1,246	1,394	1,693	2,170	2,639	2,925	3,019	2,833	2,203	1,729	1,334
60%	1,160	1,121	1,252	1,598	1,901	2,265	2,599	2,698	2,459	1,827	1,507	1,248
70%	1,094	1,014	1,097	1,305	1,673	2,034	2,219	2,310	2,002	1,460	1,257	1,201
80%	1,012	955	992	1,145	1,424	1,692	1,906	1,866	1,685	1,241	1,130	1,075
90%	910	894	898	1,007	1,241	1,491	1,668	1,522	1,259	1,102	986	890
Long Term												
Full Simulation Period ^b	1,400	1,393	1,568	1,832	2,147	2,388	2,654	2,751	2,602	2,120	1,819	1,513
Water Year Types^c												
Wet (32%)	1,691	1,732	2,189	2,554	2,832	2,942	3,300	3,488	3,445	2,964	2,626	2,109
Above Normal (16%)	1,279	1,322	1,485	1,959	2,519	2,892	3,247	3,393	3,232	2,600	2,117	1,659
Below Normal (13%)	1,542	1,497	1,507	1,719	2,122	2,397	2,653	2,714	2,530	1,923	1,513	1,307
Dry (24%)	1,206	1,158	1,177	1,305	1,582	1,938	2,178	2,210	1,951	1,478	1,287	1,144
Critical (15%)	1,092	1,029	1,019	1,108	1,223	1,381	1,408	1,392	1,243	1,018	917	865

Alternative 1												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,616	2,550	2,788	2,807	2,948	3,052	3,352	3,538	3,538	3,037	2,854	2,707
20%	2,272	2,304	2,464	2,788	2,838	2,990	3,298	3,538	3,531	2,965	2,590	2,473
30%	1,937	2,035	2,166	2,556	2,788	2,937	3,268	3,474	3,285	2,772	2,415	2,135
40%	1,699	1,784	2,024	2,366	2,788	2,841	3,209	3,278	2,983	2,367	2,000	1,795
50%	1,429	1,445	1,715	2,187	2,579	2,788	3,067	3,028	2,658	2,145	1,795	1,609
60%	1,145	1,101	1,402	1,723	2,140	2,641	2,888	2,792	2,438	1,915	1,601	1,365
70%	1,037	1,001	1,079	1,306	1,871	2,230	2,527	2,480	2,064	1,754	1,422	1,239
80%	998	974	999	1,109	1,544	1,806	1,996	2,050	1,769	1,436	1,232	1,052
90%	913	877	889	1,003	1,200	1,472	1,563	1,575	1,325	1,133	995	917
Long Term												
Full Simulation Period ^b	1,588	1,585	1,742	1,978	2,258	2,474	2,735	2,796	2,571	2,160	1,897	1,725
Water Year Types^c												
Wet (32%)	1,936	1,984	2,354	2,636	2,871	2,942	3,300	3,477	3,402	2,976	2,728	2,569
Above Normal (16%)	1,465	1,523	1,702	2,173	2,648	2,937	3,271	3,357	3,081	2,493	2,087	1,827
Below Normal (13%)	1,823	1,783	1,831	2,037	2,361	2,627	2,875	2,836	2,461	1,930	1,637	1,424
Dry (24%)	1,371	1,324	1,344	1,473	1,764	2,120	2,363	2,357	2,031	1,688	1,427	1,261
Critical (15%)	1,117	1,044	1,041	1,125	1,235	1,406	1,423	1,407	1,219	1,027	911	839

Alternative 1 minus No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	564	435	69	19	30	17	0	0	0	0	96	489
20%	496	506	432	172	50	26	0	0	-6	13	88	511
30%	320	375	365	266	0	38	0	-1	-76	25	104	311
40%	295	377	430	434	231	53	1	-42	-129	-108	38	251
50%	180	200	321	494	408	149	142	9	-175	-58	66	275
60%	-15	-20	149	126	239	377	289	94	-21	87	94	116
70%	-58	-12	-18	1	198	196	308	170	62	294	165	39
80%	-14	19	7	-36	121	114	90	185	83	195	102	-23
90%	3	-18	-9	-4	-41	-19	-105	53	66	31	9	27
Long Term												
Full Simulation Period ^b	189	193	174	146	111	86	81	45	-31	40	78	213
Water Year Types^c												
Wet (32%)	245	252	165	82	39	0	0	-10	-43	12	102	459
Above Normal (16%)	187	201	217	214	129	44	24	-37	-150	-107	-29	167
Below Normal (13%)	281	285	324	318	239	230	222	122	-69	7	125	117
Dry (24%)	165	165	167	168	182	182	185	147	80	210	140	117
Critical (15%)	25	15	22	17	12	25	16	15	-25	8	-6	-26

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-3-2. Lake Oroville, End of Month Storage

No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,052	2,115	2,719	2,788	2,918	3,035	3,352	3,538	3,538	3,037	2,759	2,218
20%	1,775	1,798	2,033	2,616	2,788	2,964	3,298	3,538	3,538	2,952	2,501	1,962
30%	1,617	1,660	1,802	2,290	2,788	2,898	3,268	3,475	3,361	2,747	2,311	1,824
40%	1,404	1,407	1,593	1,932	2,557	2,788	3,208	3,320	3,112	2,476	1,962	1,544
50%	1,248	1,246	1,394	1,693	2,170	2,639	2,925	3,019	2,833	2,203	1,729	1,334
60%	1,160	1,121	1,252	1,598	1,901	2,265	2,599	2,698	2,459	1,827	1,507	1,248
70%	1,094	1,014	1,097	1,305	1,673	2,034	2,219	2,310	2,002	1,460	1,257	1,201
80%	1,012	955	992	1,145	1,424	1,692	1,906	1,866	1,685	1,241	1,130	1,075
90%	910	894	898	1,007	1,241	1,491	1,668	1,522	1,259	1,102	986	890
Long Term												
Full Simulation Period ^b	1,400	1,393	1,568	1,832	2,147	2,388	2,654	2,751	2,602	2,120	1,819	1,513
Water Year Types^c												
Wet (32%)	1,691	1,732	2,189	2,554	2,832	2,942	3,300	3,488	3,445	2,964	2,626	2,109
Above Normal (16%)	1,279	1,322	1,485	1,959	2,519	2,892	3,247	3,393	3,232	2,600	2,117	1,659
Below Normal (13%)	1,542	1,497	1,507	1,719	2,122	2,397	2,653	2,714	2,530	1,923	1,513	1,307
Dry (24%)	1,206	1,158	1,177	1,305	1,582	1,938	2,178	2,210	1,951	1,478	1,287	1,144
Critical (15%)	1,092	1,029	1,019	1,108	1,223	1,381	1,408	1,392	1,243	1,018	917	865
Alternative 3												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,639	2,548	2,788	2,807	2,943	3,052	3,352	3,538	3,538	3,046	2,791	2,727
20%	2,094	2,155	2,500	2,788	2,802	2,983	3,298	3,538	3,522	2,898	2,518	2,283
30%	1,905	1,889	2,078	2,450	2,788	2,938	3,268	3,454	3,177	2,562	2,273	2,045
40%	1,641	1,686	1,860	2,278	2,724	2,839	3,208	3,295	2,954	2,317	1,982	1,701
50%	1,264	1,293	1,647	2,109	2,565	2,788	3,081	3,061	2,744	2,106	1,708	1,470
60%	1,195	1,126	1,375	1,678	2,130	2,642	2,884	2,819	2,450	1,867	1,429	1,251
70%	1,103	1,056	1,110	1,356	1,827	2,179	2,527	2,549	2,185	1,605	1,309	1,244
80%	1,023	964	999	1,157	1,459	1,739	2,034	2,029	1,743	1,344	1,242	1,136
90%	918	905	907	1,016	1,239	1,461	1,663	1,666	1,294	1,167	1,050	974
Long Term												
Full Simulation Period ^b	1,560	1,554	1,717	1,961	2,248	2,472	2,733	2,798	2,580	2,108	1,823	1,674
Water Year Types^c												
Wet (32%)	1,893	1,931	2,315	2,608	2,854	2,942	3,300	3,473	3,375	2,902	2,630	2,499
Above Normal (16%)	1,405	1,448	1,623	2,109	2,623	2,945	3,280	3,371	3,129	2,494	2,039	1,778
Below Normal (13%)	1,839	1,801	1,846	2,054	2,370	2,636	2,879	2,883	2,610	1,971	1,520	1,354
Dry (24%)	1,332	1,288	1,322	1,454	1,733	2,088	2,329	2,319	1,980	1,548	1,343	1,198
Critical (15%)	1,129	1,067	1,067	1,156	1,275	1,429	1,449	1,437	1,236	1,029	918	862
Alternative 3 minus No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	587	433	69	19	24	17	0	0	0	9	32	508
20%	319	357	468	172	14	19	0	0	-15	-54	16	321
30%	289	228	277	160	0	39	0	-21	-184	-185	-38	221
40%	237	279	267	346	167	51	0	-25	-158	-158	20	157
50%	15	47	253	416	395	149	155	42	-89	-98	-21	136
60%	34	5	123	80	228	377	285	121	-8	40	-78	3
70%	8	42	12	51	154	145	308	239	183	145	51	43
80%	11	10	6	13	35	47	127	164	58	103	112	61
90%	8	11	10	9	-2	-30	-5	144	34	65	64	83
Long Term												
Full Simulation Period ^b	160	161	150	129	102	84	78	48	-22	-11	3	162
Water Year Types^c												
Wet (32%)	201	199	126	54	23	0	0	-15	-70	-62	4	390
Above Normal (16%)	126	127	138	151	105	53	33	-22	-102	-106	-78	118
Below Normal (13%)	297	303	339	335	248	240	225	169	80	48	8	47
Dry (24%)	127	130	145	149	151	150	151	109	29	70	55	55
Critical (15%)	37	38	48	48	52	48	41	45	-8	10	1	-3

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
^b Based on the 82-year simulation period.
^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-3-3. Lake Oroville, End of Month Storage

No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	2,052	2,115	2,719	2,788	2,918	3,035	3,352	3,538	3,538	3,037	2,759	2,218
20%	1,775	1,798	2,033	2,616	2,788	2,964	3,298	3,538	3,538	2,952	2,501	1,962
30%	1,617	1,660	1,802	2,290	2,788	2,898	3,268	3,475	3,361	2,747	2,311	1,824
40%	1,404	1,407	1,593	1,932	2,557	2,788	3,208	3,320	3,112	2,476	1,962	1,544
50%	1,248	1,246	1,394	1,693	2,170	2,639	2,925	3,019	2,833	2,203	1,729	1,334
60%	1,160	1,121	1,252	1,598	1,901	2,265	2,599	2,698	2,459	1,827	1,507	1,248
70%	1,094	1,014	1,097	1,305	1,673	2,034	2,219	2,310	2,002	1,460	1,257	1,201
80%	1,012	955	992	1,145	1,424	1,692	1,906	1,866	1,685	1,241	1,130	1,075
90%	910	894	898	1,007	1,241	1,491	1,668	1,522	1,259	1,102	986	890
Long Term												
Full Simulation Period ^b	1,400	1,393	1,568	1,832	2,147	2,388	2,654	2,751	2,602	2,120	1,819	1,513
Water Year Types ^c												
Wet (32%)	1,691	1,732	2,189	2,554	2,832	2,942	3,300	3,488	3,445	2,964	2,626	2,109
Above Normal (16%)	1,279	1,322	1,485	1,959	2,519	2,892	3,247	3,393	3,232	2,600	2,117	1,659
Below Normal (13%)	1,542	1,497	1,507	1,719	2,122	2,397	2,653	2,714	2,530	1,923	1,513	1,307
Dry (24%)	1,206	1,158	1,177	1,305	1,582	1,938	2,178	2,210	1,951	1,478	1,287	1,144
Critical (15%)	1,092	1,029	1,019	1,108	1,223	1,381	1,408	1,392	1,243	1,018	917	865

Alternative 5												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	2,047	2,116	2,763	2,788	2,921	3,035	3,352	3,538	3,538	3,017	2,704	2,150
20%	1,778	1,801	2,036	2,655	2,788	2,964	3,298	3,538	3,538	2,951	2,508	1,961
30%	1,614	1,653	1,810	2,267	2,788	2,898	3,268	3,475	3,367	2,759	2,317	1,829
40%	1,402	1,371	1,559	1,931	2,557	2,788	3,208	3,336	3,132	2,493	2,005	1,562
50%	1,248	1,251	1,433	1,709	2,177	2,642	2,928	3,020	2,849	2,218	1,753	1,349
60%	1,170	1,145	1,252	1,595	1,940	2,279	2,607	2,720	2,516	1,870	1,438	1,245
70%	1,101	1,050	1,095	1,309	1,693	2,044	2,225	2,340	2,049	1,478	1,243	1,176
80%	1,011	974	1,004	1,166	1,440	1,710	1,910	1,894	1,717	1,241	1,135	1,051
90%	894	895	903	1,030	1,250	1,489	1,661	1,579	1,306	1,167	1,050	954
Long Term												
Full Simulation Period ^b	1,403	1,394	1,568	1,836	2,151	2,393	2,660	2,770	2,622	2,134	1,821	1,514
Water Year Types ^c												
Wet (32%)	1,681	1,723	2,179	2,556	2,833	2,942	3,300	3,488	3,447	2,961	2,613	2,103
Above Normal (16%)	1,275	1,310	1,471	1,948	2,512	2,892	3,247	3,401	3,241	2,608	2,125	1,668
Below Normal (13%)	1,552	1,507	1,517	1,728	2,132	2,406	2,663	2,746	2,569	1,959	1,521	1,305
Dry (24%)	1,223	1,173	1,190	1,319	1,595	1,952	2,193	2,255	1,992	1,502	1,295	1,150
Critical (15%)	1,102	1,037	1,025	1,114	1,229	1,383	1,415	1,411	1,266	1,045	929	873

Alternative 5 minus No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-5	1	44	0	3	0	0	0	0	-20	-54	-68
20%	2	3	3	39	0	0	0	0	0	-1	6	-1
30%	-3	-8	8	-23	0	0	0	0	6	12	6	5
40%	-2	-36	-35	0	0	0	0	16	20	18	43	18
50%	0	5	39	16	7	3	2	1	16	15	24	14
60%	10	24	0	-2	39	15	7	22	58	42	-70	-4
70%	7	37	-3	4	21	10	6	30	47	18	-14	-24
80%	0	20	12	21	17	18	4	29	32	0	5	-24
90%	-16	0	5	23	9	-2	-7	57	47	64	64	64
Long Term												
Full Simulation Period ^b	3	1	0	4	5	5	6	19	21	15	2	2
Water Year Types ^c												
Wet (32%)	-10	-9	-10	1	1	0	0	0	2	-3	-13	-7
Above Normal (16%)	-3	-12	-14	-11	-7	0	0	8	8	8	8	9
Below Normal (13%)	10	10	10	9	10	10	10	32	39	36	8	-1
Dry (24%)	17	15	13	13	13	13	15	45	41	23	8	6
Critical (15%)	10	9	6	6	6	3	7	19	22	27	12	8

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-3-4. Lake Oroville, End of Month Storage

Second Basis of Comparison		End of Month Storage (TAF)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	2,616	2,550	2,788	2,807	2,948	3,052	3,352	3,538	3,538	3,037	2,854	2,707	
20%	2,272	2,304	2,464	2,788	2,838	2,990	3,298	3,538	3,531	2,965	2,590	2,473	
30%	1,937	2,035	2,166	2,556	2,788	2,937	3,268	3,474	3,285	2,772	2,415	2,135	
40%	1,699	1,784	2,024	2,366	2,788	2,841	3,209	3,278	2,983	2,367	2,000	1,795	
50%	1,429	1,445	1,715	2,187	2,579	2,788	3,067	3,028	2,658	2,145	1,795	1,609	
60%	1,145	1,101	1,402	1,723	2,140	2,641	2,888	2,792	2,438	1,915	1,601	1,365	
70%	1,037	1,001	1,079	1,306	1,871	2,230	2,527	2,480	2,064	1,754	1,422	1,239	
80%	998	974	999	1,109	1,544	1,806	1,996	2,050	1,769	1,436	1,232	1,052	
90%	913	877	889	1,003	1,200	1,472	1,563	1,575	1,325	1,133	995	917	
Long Term													
Full Simulation Period ^b	1,588	1,585	1,742	1,978	2,258	2,474	2,735	2,796	2,571	2,160	1,897	1,725	
Water Year Types^c													
Wet (32%)	1,936	1,984	2,354	2,636	2,871	2,942	3,300	3,477	3,402	2,976	2,728	2,569	
Above Normal (16%)	1,465	1,523	1,702	2,173	2,648	2,937	3,271	3,357	3,081	2,493	2,087	1,827	
Below Normal (13%)	1,823	1,783	1,831	2,037	2,361	2,627	2,875	2,836	2,461	1,930	1,637	1,424	
Dry (24%)	1,371	1,324	1,344	1,473	1,764	2,120	2,363	2,357	2,031	1,688	1,427	1,261	
Critical (15%)	1,117	1,044	1,041	1,125	1,235	1,406	1,423	1,407	1,219	1,027	911	839	

No Action Alternative		End of Month Storage (TAF)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	2,052	2,115	2,719	2,788	2,918	3,035	3,352	3,538	3,538	3,037	2,759	2,218	
20%	1,775	1,798	2,033	2,616	2,788	2,964	3,298	3,538	3,538	2,952	2,501	1,962	
30%	1,617	1,660	1,802	2,290	2,788	2,898	3,268	3,475	3,361	2,747	2,311	1,824	
40%	1,404	1,407	1,593	1,932	2,557	2,788	3,208	3,320	3,112	2,476	1,962	1,544	
50%	1,248	1,246	1,394	1,693	2,170	2,639	2,925	3,019	2,833	2,203	1,729	1,334	
60%	1,160	1,121	1,252	1,598	1,901	2,265	2,599	2,698	2,459	1,827	1,507	1,248	
70%	1,094	1,014	1,097	1,305	1,673	2,034	2,219	2,310	2,002	1,460	1,257	1,201	
80%	1,012	955	992	1,145	1,424	1,692	1,906	1,866	1,685	1,241	1,130	1,075	
90%	910	894	898	1,007	1,241	1,491	1,668	1,522	1,259	1,102	986	890	
Long Term													
Full Simulation Period ^b	1,400	1,393	1,568	1,832	2,147	2,388	2,654	2,751	2,602	2,120	1,819	1,513	
Water Year Types^c													
Wet (32%)	1,691	1,732	2,189	2,554	2,832	2,942	3,300	3,488	3,445	2,964	2,626	2,109	
Above Normal (16%)	1,279	1,322	1,485	1,959	2,519	2,892	3,247	3,393	3,232	2,600	2,117	1,659	
Below Normal (13%)	1,542	1,497	1,507	1,719	2,122	2,397	2,653	2,714	2,530	1,923	1,513	1,307	
Dry (24%)	1,206	1,158	1,177	1,305	1,582	1,938	2,178	2,210	1,951	1,478	1,287	1,144	
Critical (15%)	1,092	1,029	1,019	1,108	1,223	1,381	1,408	1,392	1,243	1,018	917	865	

No Action Alternative minus Second Basis of Comparison		End of Month Storage (TAF)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	-564	-435	-69	-19	-30	-17	0	0	0	0	-96	-489	
20%	-496	-506	-432	-172	-50	-26	0	0	6	-13	-88	-511	
30%	-320	-375	-365	-266	0	-38	0	1	76	-25	-104	-311	
40%	-295	-377	-430	-434	-231	-53	-1	42	129	108	-38	-251	
50%	-180	-200	-321	-494	-408	-149	-142	-9	175	58	-66	-275	
60%	15	20	-149	-126	-239	-377	-289	-94	21	-87	-94	-116	
70%	58	12	18	-1	-198	-196	-308	-170	-62	-294	-165	-39	
80%	14	-19	-7	36	-121	-114	-90	-185	-83	-195	-102	23	
90%	-3	18	9	4	41	19	105	-53	-66	-31	-9	-27	
Long Term													
Full Simulation Period ^b	-189	-193	-174	-146	-111	-86	-81	-45	31	-40	-78	-213	
Water Year Types^c													
Wet (32%)	-245	-252	-165	-82	-39	0	0	10	43	-12	-102	-459	
Above Normal (16%)	-187	-201	-217	-214	-129	-44	-24	37	150	107	29	-167	
Below Normal (13%)	-281	-285	-324	-318	-239	-230	-222	-122	69	-7	-125	-117	
Dry (24%)	-165	-165	-167	-168	-182	-182	-185	-147	-80	-210	-140	-117	
Critical (15%)	-25	-15	-22	-17	-12	-25	-16	-15	25	-8	6	26	

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-3-5. Lake Oroville, End of Month Storage

Second Basis of Comparison												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,616	2,550	2,788	2,807	2,948	3,052	3,352	3,538	3,538	3,037	2,854	2,707
20%	2,272	2,304	2,464	2,788	2,838	2,990	3,298	3,538	3,531	2,965	2,590	2,473
30%	1,937	2,035	2,166	2,556	2,788	2,937	3,268	3,474	3,285	2,772	2,415	2,135
40%	1,699	1,784	2,024	2,366	2,788	2,841	3,209	3,278	2,983	2,367	2,000	1,795
50%	1,429	1,445	1,715	2,187	2,579	2,788	3,067	3,028	2,658	2,145	1,795	1,609
60%	1,145	1,101	1,402	1,723	2,140	2,641	2,888	2,792	2,438	1,915	1,601	1,365
70%	1,037	1,001	1,079	1,306	1,871	2,230	2,527	2,480	2,064	1,754	1,422	1,239
80%	998	974	999	1,109	1,544	1,806	1,996	2,050	1,769	1,436	1,232	1,052
90%	913	877	889	1,003	1,200	1,472	1,563	1,575	1,325	1,133	995	917
Long Term												
Full Simulation Period ^b	1,588	1,585	1,742	1,978	2,258	2,474	2,735	2,796	2,571	2,160	1,897	1,725
Water Year Types^c												
Wet (32%)	1,936	1,984	2,354	2,636	2,871	2,942	3,300	3,477	3,402	2,976	2,728	2,569
Above Normal (16%)	1,465	1,523	1,702	2,173	2,648	2,937	3,271	3,357	3,081	2,493	2,087	1,827
Below Normal (13%)	1,823	1,783	1,831	2,037	2,361	2,627	2,875	2,836	2,461	1,930	1,637	1,424
Dry (24%)	1,371	1,324	1,344	1,473	1,764	2,120	2,363	2,357	2,031	1,688	1,427	1,261
Critical (15%)	1,117	1,044	1,041	1,125	1,235	1,406	1,423	1,407	1,219	1,027	911	839

Alternative 3												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,639	2,548	2,788	2,807	2,943	3,052	3,352	3,538	3,538	3,046	2,791	2,727
20%	2,094	2,155	2,500	2,788	2,802	2,983	3,298	3,538	3,522	2,898	2,518	2,283
30%	1,905	1,889	2,078	2,450	2,788	2,938	3,268	3,454	3,177	2,562	2,273	2,045
40%	1,641	1,686	1,860	2,278	2,724	2,839	3,208	3,295	2,954	2,317	1,982	1,701
50%	1,264	1,293	1,647	2,109	2,565	2,788	3,081	3,061	2,744	2,106	1,708	1,470
60%	1,195	1,126	1,375	1,678	2,130	2,642	2,884	2,819	2,450	1,867	1,429	1,251
70%	1,103	1,056	1,110	1,356	1,827	2,179	2,527	2,549	2,185	1,605	1,309	1,244
80%	1,023	964	999	1,157	1,459	1,739	2,034	2,029	1,743	1,344	1,242	1,136
90%	918	905	907	1,016	1,239	1,461	1,663	1,666	1,294	1,167	1,050	974
Long Term												
Full Simulation Period ^b	1,560	1,554	1,717	1,961	2,248	2,472	2,733	2,798	2,580	2,108	1,823	1,674
Water Year Types^c												
Wet (32%)	1,893	1,931	2,315	2,608	2,854	2,942	3,300	3,473	3,375	2,902	2,630	2,499
Above Normal (16%)	1,405	1,448	1,623	2,109	2,623	2,945	3,280	3,371	3,129	2,494	2,039	1,778
Below Normal (13%)	1,839	1,801	1,846	2,054	2,370	2,636	2,879	2,883	2,610	1,971	1,520	1,354
Dry (24%)	1,332	1,288	1,322	1,454	1,733	2,088	2,329	2,319	1,980	1,548	1,343	1,198
Critical (15%)	1,129	1,067	1,067	1,156	1,275	1,429	1,449	1,437	1,236	1,029	918	862

Alternative 3 minus Second Basis of Comparison												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	23	-2	0	0	-6	0	0	0	0	9	-64	20
20%	-178	-149	36	0	-35	-6	0	0	-9	-66	-72	-190
30%	-31	-147	-88	-107	0	1	0	-19	-108	-210	-142	-90
40%	-58	-98	-164	-88	-64	-3	-1	17	-29	-50	-19	-94
50%	-165	-152	-68	-78	-13	0	13	32	86	-39	-87	-139
60%	49	25	-27	-46	-10	0	-4	27	13	-47	-172	-113
70%	66	54	31	50	-44	-51	0	69	121	-149	-114	5
80%	25	-10	0	48	-86	-68	38	-21	-25	-92	10	84
90%	5	29	18	14	39	-11	100	91	-32	34	55	57
Long Term												
Full Simulation Period ^b	-29	-31	-25	-17	-10	-2	-3	2	9	-52	-74	-51
Water Year Types^c												
Wet (32%)	-43	-53	-39	-28	-17	0	0	-5	-27	-73	-98	-70
Above Normal (16%)	-61	-75	-78	-64	-24	8	8	14	48	1	-49	-49
Below Normal (13%)	16	18	15	17	9	9	3	47	150	41	-117	-70
Dry (24%)	-38	-35	-22	-19	-31	-32	-34	-38	-51	-140	-84	-62
Critical (15%)	12	23	25	31	39	23	25	30	17	2	7	23

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-3-6. Lake Oroville, End of Month Storage

Second Basis of Comparison		End of Month Storage (TAF)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,616	2,550	2,788	2,807	2,948	3,052	3,352	3,538	3,538	3,037	2,854	2,707
20%	2,272	2,304	2,464	2,788	2,838	2,990	3,298	3,538	3,531	2,965	2,590	2,473
30%	1,937	2,035	2,166	2,556	2,788	2,937	3,268	3,474	3,285	2,772	2,415	2,135
40%	1,699	1,784	2,024	2,366	2,788	2,841	3,209	3,278	2,983	2,367	2,000	1,795
50%	1,429	1,445	1,715	2,187	2,579	2,788	3,067	3,028	2,658	2,145	1,795	1,609
60%	1,145	1,101	1,402	1,723	2,140	2,641	2,888	2,792	2,438	1,915	1,601	1,365
70%	1,037	1,001	1,079	1,306	1,871	2,230	2,527	2,480	2,064	1,754	1,422	1,239
80%	998	974	999	1,109	1,544	1,806	1,996	2,050	1,769	1,436	1,232	1,052
90%	913	877	889	1,003	1,200	1,472	1,563	1,575	1,325	1,133	995	917
Long Term												
Full Simulation Period ^b	1,588	1,585	1,742	1,978	2,258	2,474	2,735	2,796	2,571	2,160	1,897	1,725
Water Year Types^c												
Wet (32%)	1,936	1,984	2,354	2,636	2,871	2,942	3,300	3,477	3,402	2,976	2,728	2,569
Above Normal (16%)	1,465	1,523	1,702	2,173	2,648	2,937	3,271	3,357	3,081	2,493	2,087	1,827
Below Normal (13%)	1,823	1,783	1,831	2,037	2,361	2,627	2,875	2,836	2,461	1,930	1,637	1,424
Dry (24%)	1,371	1,324	1,344	1,473	1,764	2,120	2,363	2,357	2,031	1,688	1,427	1,261
Critical (15%)	1,117	1,044	1,041	1,125	1,235	1,406	1,423	1,407	1,219	1,027	911	839

Alternative 5

Alternative 5		End of Month Storage (TAF)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,047	2,116	2,763	2,788	2,921	3,035	3,352	3,538	3,538	3,017	2,704	2,150
20%	1,778	1,801	2,036	2,655	2,788	2,964	3,298	3,538	3,538	2,951	2,508	1,961
30%	1,614	1,653	1,810	2,267	2,788	2,898	3,268	3,475	3,367	2,759	2,317	1,829
40%	1,402	1,371	1,559	1,931	2,557	2,788	3,208	3,336	3,132	2,493	2,005	1,562
50%	1,248	1,251	1,433	1,709	2,177	2,642	2,928	3,020	2,849	2,218	1,753	1,349
60%	1,170	1,145	1,252	1,595	1,940	2,279	2,607	2,720	2,516	1,870	1,438	1,245
70%	1,101	1,050	1,095	1,309	1,693	2,044	2,225	2,340	2,049	1,478	1,243	1,176
80%	1,011	974	1,004	1,166	1,440	1,710	1,910	1,894	1,717	1,241	1,135	1,051
90%	894	895	903	1,030	1,250	1,489	1,661	1,579	1,306	1,167	1,050	954
Long Term												
Full Simulation Period ^b	1,403	1,394	1,568	1,836	2,151	2,393	2,660	2,770	2,622	2,134	1,821	1,514
Water Year Types^c												
Wet (32%)	1,681	1,723	2,179	2,556	2,833	2,942	3,300	3,488	3,447	2,961	2,613	2,103
Above Normal (16%)	1,275	1,310	1,471	1,948	2,512	2,892	3,247	3,401	3,241	2,608	2,125	1,668
Below Normal (13%)	1,552	1,507	1,517	1,728	2,132	2,406	2,663	2,746	2,569	1,959	1,521	1,305
Dry (24%)	1,223	1,173	1,190	1,319	1,595	1,952	2,193	2,255	1,992	1,502	1,295	1,150
Critical (15%)	1,102	1,037	1,025	1,114	1,229	1,383	1,415	1,411	1,266	1,045	929	873

Alternative 5 minus Second Basis of Comparison

Alternative 5 minus Second Basis of Comparison		End of Month Storage (TAF)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-569	-434	-25	-19	-27	-17	0	0	0	-20	-150	-557
20%	-494	-503	-428	-133	-50	-26	0	0	6	-14	-82	-512
30%	-323	-383	-357	-289	0	-38	0	1	82	-14	-97	-306
40%	-297	-414	-465	-434	-230	-53	-1	58	149	126	5	-233
50%	-181	-194	-282	-478	-402	-146	-140	-8	191	73	-42	-261
60%	25	44	-149	-128	-200	-362	-281	-72	79	-45	-163	-120
70%	65	49	16	3	-177	-186	-303	-140	-15	-276	-180	-63
80%	14	0	5	57	-104	-97	-86	-156	-52	-195	-96	-2
90%	-19	18	14	27	50	17	98	4	-19	33	55	38
Long Term												
Full Simulation Period ^b	-186	-191	-174	-142	-106	-81	-75	-26	51	-25	-76	-211
Water Year Types^c												
Wet (32%)	-255	-261	-175	-81	-38	0	0	10	45	-15	-115	-466
Above Normal (16%)	-190	-213	-231	-225	-136	-44	-24	44	159	115	37	-159
Below Normal (13%)	-271	-275	-314	-309	-228	-220	-212	-90	109	28	-116	-118
Dry (24%)	-148	-151	-153	-155	-169	-168	-170	-102	-39	-186	-132	-111
Critical (15%)	-15	-7	-17	-11	-7	-23	-8	4	47	19	18	34

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 C.4. Folsom Storage

Figure C-4-1. Folsom Lake, End of May Storage

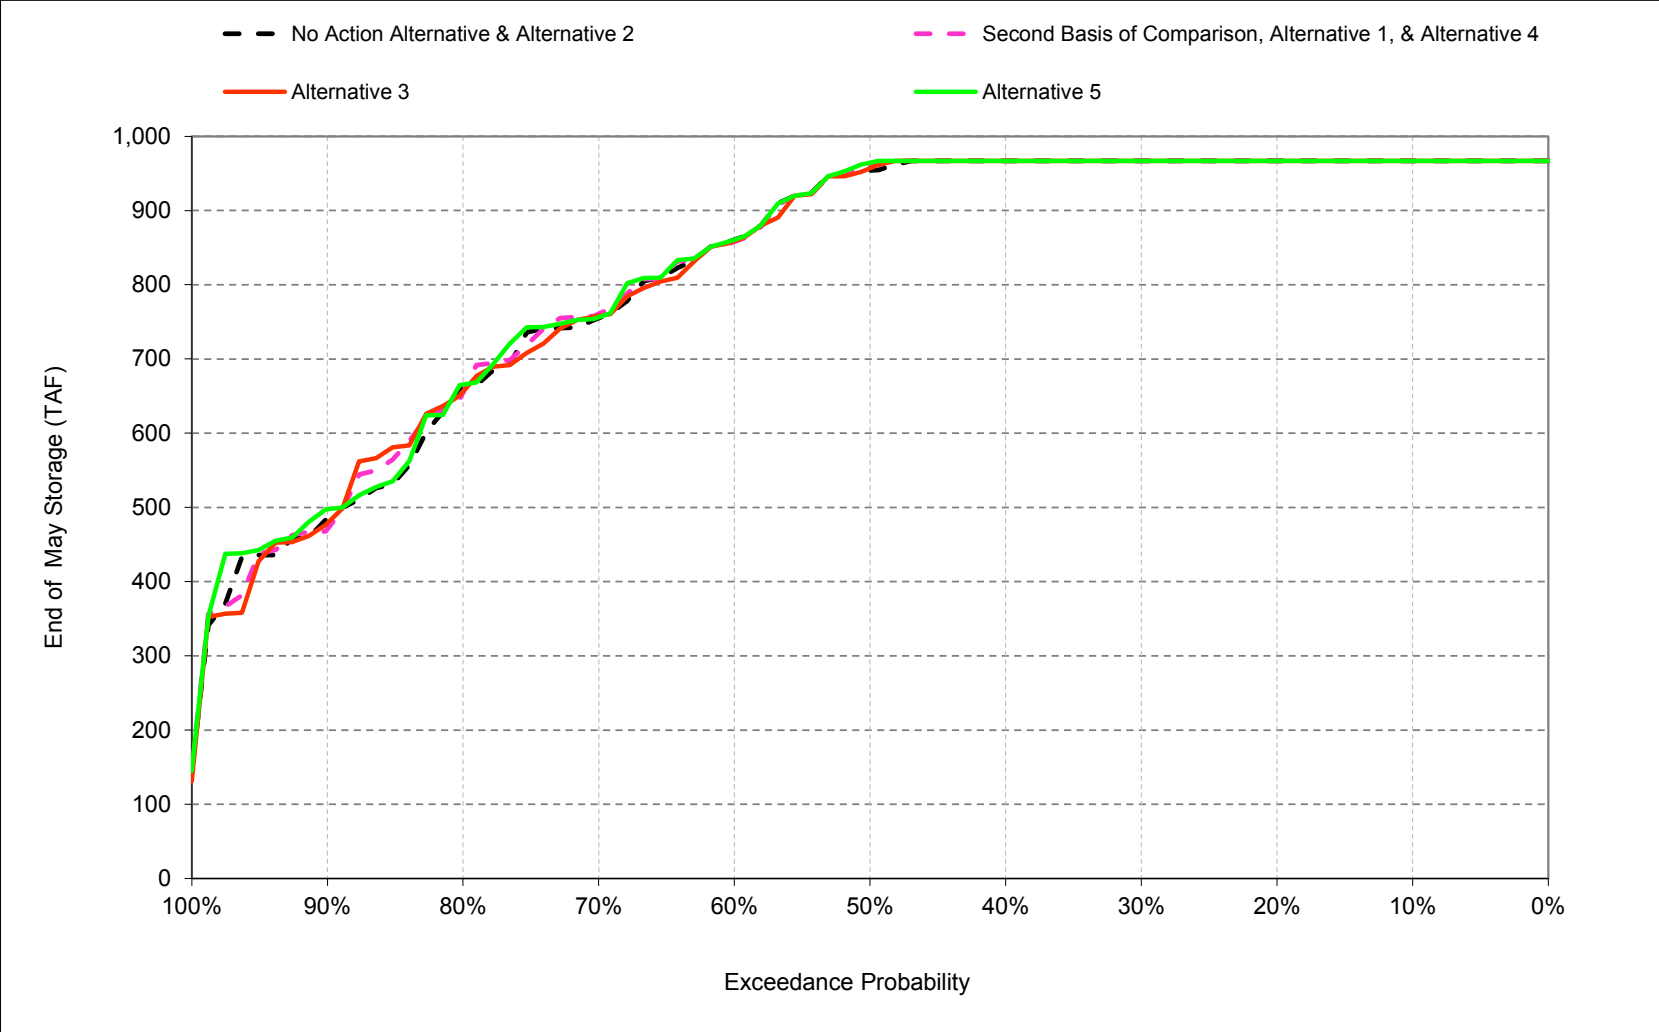

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-4-2. Folsom Lake, End of September Storage

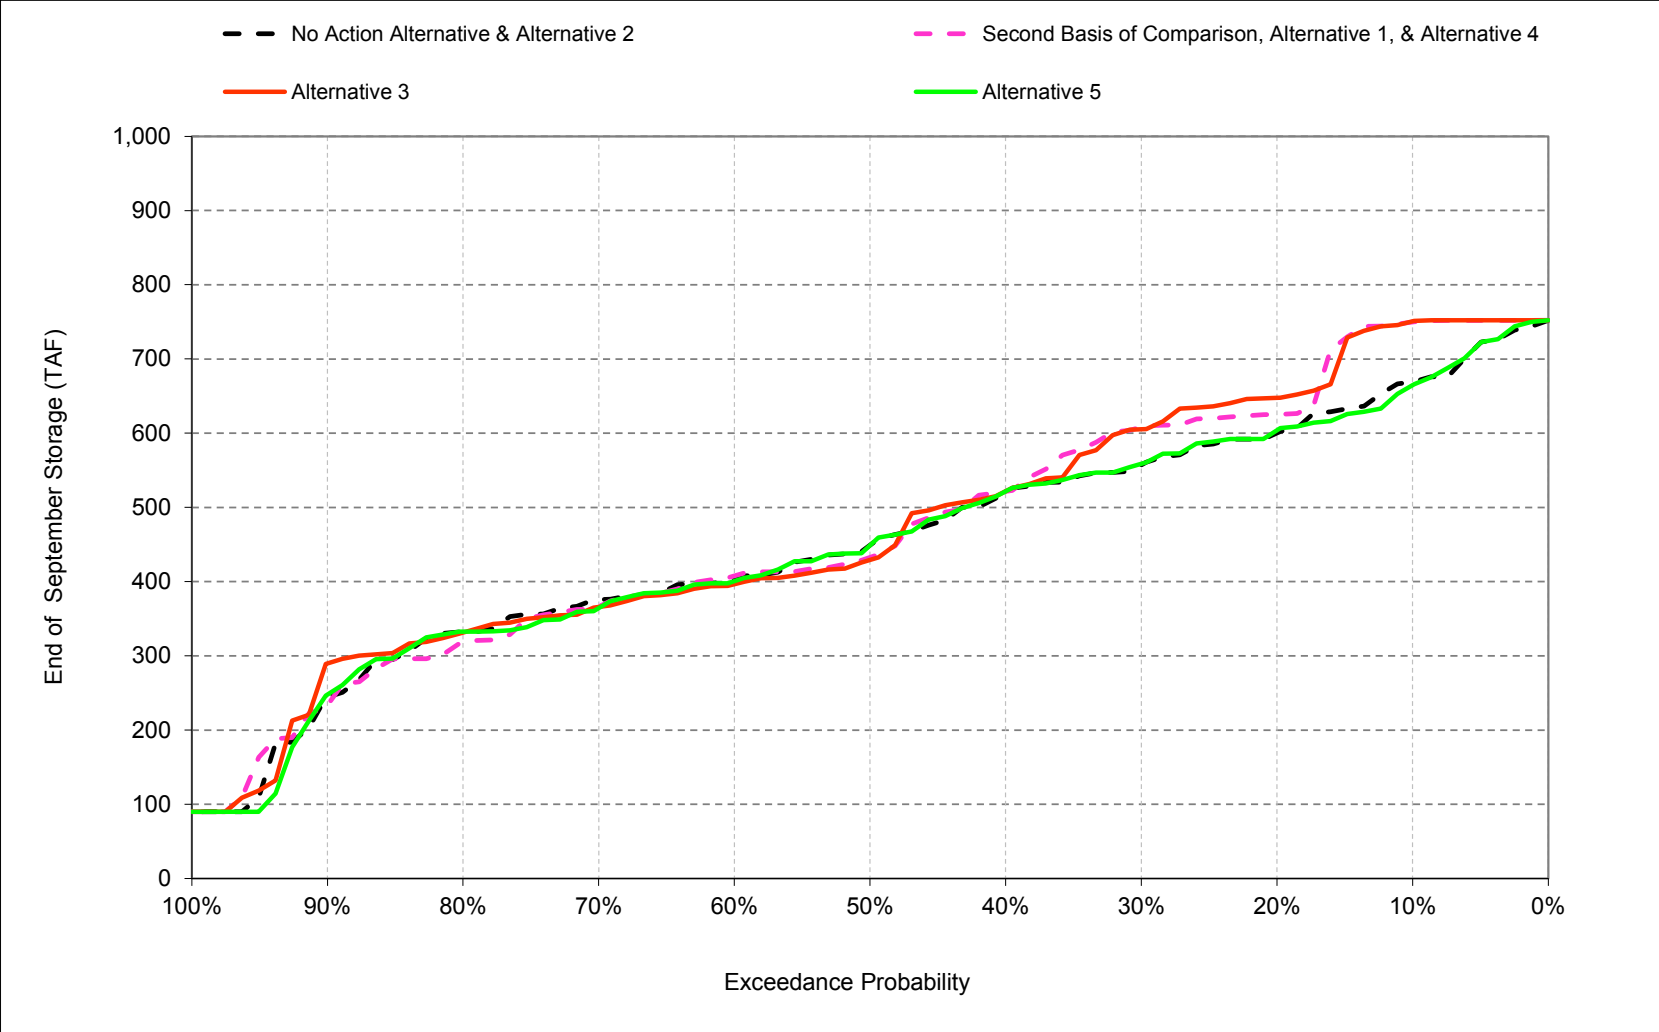

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-4-1. Folsom Lake, End of Month Storage

No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	592	531	567	567	567	661	792	967	967	910	792	669
20%	538	493	567	565	566	656	792	967	967	828	732	600
30%	497	461	539	557	558	652	792	967	967	738	682	557
40%	451	426	498	540	553	646	792	967	933	664	607	521
50%	412	407	444	475	530	633	792	954	874	592	514	449
60%	354	392	416	444	496	621	790	861	761	521	455	402
70%	330	354	390	424	457	593	735	755	677	427	381	376
80%	296	307	349	365	415	542	630	661	549	380	357	332
90%	225	248	240	298	384	429	480	485	432	328	282	244
Long Term												
Full Simulation Period ^b	407	394	439	461	490	589	713	821	765	591	524	455
Water Year Types^c												
Wet (32%)	454	435	514	518	515	632	785	951	941	800	712	576
Above Normal (16%)	377	380	429	513	531	640	787	946	887	621	552	477
Below Normal (13%)	446	431	467	484	533	619	757	843	780	527	472	453
Dry (24%)	394	383	408	423	479	579	691	760	658	495	443	419
Critical (15%)	324	305	315	320	366	432	475	486	415	327	267	231

Alternative 1												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	689	567	567	567	567	661	792	967	967	906	792	750
20%	582	561	567	567	567	657	792	967	967	817	684	625
30%	552	528	566	563	559	653	792	967	965	728	638	608
40%	469	499	525	556	555	646	792	967	908	641	569	522
50%	400	430	500	523	537	633	792	959	807	546	468	433
60%	351	391	456	470	498	621	790	858	745	504	442	408
70%	336	356	405	430	457	601	733	761	630	433	387	366
80%	291	333	352	388	437	563	634	654	544	371	325	318
90%	253	259	266	311	392	455	489	471	426	309	244	233
Long Term												
Full Simulation Period ^b	431	424	457	475	494	592	715	823	757	579	503	471
Water Year Types^c												
Wet (32%)	483	470	522	524	515	632	785	951	937	793	688	646
Above Normal (16%)	390	412	467	537	538	640	787	946	857	591	522	485
Below Normal (13%)	506	489	502	514	541	626	761	847	739	475	408	387
Dry (24%)	405	399	423	437	486	585	698	769	664	486	432	408
Critical (15%)	339	317	323	325	369	436	469	482	430	352	288	258

Alternative 1 minus No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	97	36	0	0	0	0	0	0	0	-4	0	81
20%	45	68	0	2	1	1	0	0	0	-11	-48	25
30%	55	67	27	6	1	2	0	0	-2	-10	-44	51
40%	18	73	26	15	2	0	0	0	-25	-23	-37	1
50%	-12	23	56	48	7	0	0	5	-67	-45	-46	-17
60%	-2	-1	40	26	2	0	0	-3	-16	-17	-13	6
70%	6	1	14	6	0	8	-2	6	-47	7	6	-9
80%	-4	27	3	22	22	21	4	-7	-5	-9	-32	-15
90%	27	11	26	13	8	26	10	-14	-6	-19	-39	-11
Long Term												
Full Simulation Period ^b	24	29	18	14	4	3	1	2	-8	-13	-21	16
Water Year Types^c												
Wet (32%)	29	35	8	6	0	0	0	0	-4	-7	-25	70
Above Normal (16%)	13	33	38	24	7	0	0	-1	-30	-31	-30	8
Below Normal (13%)	59	58	35	30	8	7	4	4	-41	-52	-64	-66
Dry (24%)	12	16	15	14	7	6	7	9	5	-9	-11	-11
Critical (15%)	14	11	9	5	3	3	-6	-4	16	25	21	28

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-4-2. Folsom Lake, End of Month Storage

No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	592	531	567	567	567	661	792	967	967	910	792	669
20%	538	493	567	565	566	656	792	967	967	828	732	600
30%	497	461	539	557	558	652	792	967	967	738	682	557
40%	451	426	498	540	553	646	792	967	933	664	607	521
50%	412	407	444	475	530	633	792	954	874	592	514	449
60%	354	392	416	444	496	621	790	861	761	521	455	402
70%	330	354	390	424	457	593	735	755	677	427	381	376
80%	296	307	349	365	415	542	630	661	549	380	357	332
90%	225	248	240	298	384	429	480	485	432	328	282	244
Long Term												
Full Simulation Period ^b	407	394	439	461	490	589	713	821	765	591	524	455
Water Year Types ^c												
Wet (32%)	454	435	514	518	515	632	785	951	941	800	712	576
Above Normal (16%)	377	380	429	513	531	640	787	946	887	621	552	477
Below Normal (13%)	446	431	467	484	533	619	757	843	780	527	472	453
Dry (24%)	394	383	408	423	479	579	691	760	658	495	443	419
Critical (15%)	324	305	315	320	366	432	475	486	415	327	267	231

Alternative 3												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	688	567	567	567	567	661	792	967	967	921	792	751
20%	592	563	567	567	567	656	792	967	967	814	709	648
30%	548	537	564	564	560	652	792	967	958	726	647	605
40%	483	495	523	556	556	646	792	967	899	636	567	522
50%	396	432	502	520	545	633	792	957	793	546	465	429
60%	348	387	450	469	499	621	790	859	749	485	434	397
70%	329	358	405	431	457	603	734	758	655	431	381	366
80%	304	329	342	389	438	563	649	656	547	392	346	331
90%	259	260	251	297	384	446	484	479	428	312	285	290
Long Term												
Full Simulation Period ^b	432	424	456	474	493	591	714	822	755	580	508	473
Water Year Types ^c												
Wet (32%)	486	473	525	524	515	632	785	951	929	790	690	645
Above Normal (16%)	388	404	454	537	539	640	787	946	851	580	516	479
Below Normal (13%)	513	496	505	514	542	627	764	844	766	506	436	407
Dry (24%)	405	398	420	434	482	580	692	761	654	491	436	411
Critical (15%)	331	314	322	325	370	436	474	485	431	343	291	257

Alternative 3 minus No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	96	36	0	0	0	0	0	0	0	12	0	82
20%	54	70	0	2	1	0	0	0	0	-14	-23	48
30%	51	75	25	7	2	0	0	0	-9	-12	-35	48
40%	32	69	25	16	3	0	0	0	-34	-28	-40	1
50%	-16	25	58	45	16	0	0	3	-81	-45	-49	-20
60%	-6	-5	35	25	3	0	0	-2	-12	-36	-22	-6
70%	-1	4	14	7	0	9	-1	3	-22	5	1	-10
80%	8	22	-8	24	23	21	19	-5	-2	12	-10	-1
90%	33	12	11	-1	0	17	5	-6	-4	-15	2	45
Long Term												
Full Simulation Period ^b	25	29	17	13	4	2	1	0	-10	-11	-16	18
Water Year Types ^c												
Wet (32%)	33	38	11	6	0	0	0	0	-12	-10	-22	69
Above Normal (16%)	11	24	25	25	8	0	0	0	-36	-41	-36	2
Below Normal (13%)	67	64	38	30	9	8	6	1	-14	-21	-36	-45
Dry (24%)	11	15	12	11	3	1	1	1	-4	-4	-7	-8
Critical (15%)	7	8	8	5	3	3	-1	-1	16	16	25	27

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-4-3. Folsom Lake, End of Month Storage

No Action Alternative

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	592	531	567	567	567	661	792	967	967	910	792	669
20%	538	493	567	565	566	656	792	967	967	828	732	600
30%	497	461	539	557	558	652	792	967	967	738	682	557
40%	451	426	498	540	553	646	792	967	933	664	607	521
50%	412	407	444	475	530	633	792	954	874	592	514	449
60%	354	392	416	444	496	621	790	861	761	521	455	402
70%	330	354	390	424	457	593	735	755	677	427	381	376
80%	296	307	349	365	415	542	630	661	549	380	357	332
90%	225	248	240	298	384	429	480	485	432	328	282	244
Long Term												
Full Simulation Period ^b	407	394	439	461	490	589	713	821	765	591	524	455
Water Year Types ^c												
Wet (32%)	454	435	514	518	515	632	785	951	941	800	712	576
Above Normal (16%)	377	380	429	513	531	640	787	946	887	621	552	477
Below Normal (13%)	446	431	467	484	533	619	757	843	780	527	472	453
Dry (24%)	394	383	408	423	479	579	691	760	658	495	443	419
Critical (15%)	324	305	315	320	366	432	475	486	415	327	267	231

Alternative 5

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	592	533	567	567	567	661	792	967	967	869	792	665
20%	538	489	567	565	566	656	792	967	967	818	733	604
30%	503	463	537	557	558	652	792	967	967	738	664	559
40%	455	429	503	541	553	646	792	967	933	665	608	521
50%	412	409	444	479	530	633	792	965	874	595	514	449
60%	353	392	417	448	496	621	790	861	773	524	460	401
70%	329	353	400	422	450	593	736	756	682	432	386	364
80%	294	314	350	370	412	542	626	665	552	383	349	333
90%	227	249	239	299	381	432	484	498	430	331	285	248
Long Term												
Full Simulation Period ^b	407	394	439	461	490	590	715	825	766	587	520	453
Water Year Types ^c												
Wet (32%)	454	435	515	518	515	632	785	952	941	794	710	577
Above Normal (16%)	375	379	428	513	532	640	787	946	888	622	554	478
Below Normal (13%)	440	425	461	483	534	620	758	845	783	523	469	450
Dry (24%)	397	386	411	426	479	579	691	766	664	489	435	410
Critical (15%)	325	304	314	320	367	433	483	499	411	324	257	231

Alternative 5 minus No Action Alternative

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0	3	0	0	0	0	0	0	0	-40	0	-5
20%	0	-4	0	0	0	0	0	0	0	-10	2	4
30%	6	2	-2	0	0	0	0	0	0	0	-17	2
40%	4	3	4	0	0	0	0	0	0	1	1	1
50%	0	2	0	4	0	0	0	11	0	4	0	0
60%	0	0	1	5	0	0	0	0	12	3	5	-2
70%	-1	-2	10	-3	-8	0	1	1	5	6	5	-11
80%	-1	7	0	4	-3	0	-4	4	3	2	-8	0
90%	2	0	-1	0	-3	3	5	13	-1	3	3	3
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	1	4	1	-4	-4	-2
Water Year Types ^c												
Wet (32%)	0	0	0	0	0	0	0	1	0	-6	-2	1
Above Normal (16%)	-2	-1	-1	1	1	0	0	0	1	1	2	1
Below Normal (13%)	-6	-7	-6	-2	0	0	0	2	3	-4	-3	-3
Dry (24%)	3	3	3	2	0	0	0	6	6	-5	-8	-9
Critical (15%)	1	-1	0	0	0	0	8	13	-4	-3	-10	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-4-4. Folsom Lake, End of Month Storage

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	689	567	567	567	567	661	792	967	967	906	792	750
20%	582	561	567	567	567	657	792	967	967	817	684	625
30%	552	528	566	563	559	653	792	967	965	728	638	608
40%	469	499	525	556	555	646	792	967	908	641	569	522
50%	400	430	500	523	537	633	792	959	807	546	468	433
60%	351	391	456	470	498	621	790	858	745	504	442	408
70%	336	356	405	430	457	601	733	761	630	433	387	366
80%	291	333	352	388	437	563	634	654	544	371	325	318
90%	253	259	266	311	392	455	489	471	426	309	244	233
Long Term												
Full Simulation Period ^b	431	424	457	475	494	592	715	823	757	579	503	471
Water Year Types ^c												
Wet (32%)	483	470	522	524	515	632	785	951	937	793	688	646
Above Normal (16%)	390	412	467	537	538	640	787	946	857	591	522	485
Below Normal (13%)	506	489	502	514	541	626	761	847	739	475	408	387
Dry (24%)	405	399	423	437	486	585	698	769	664	486	432	408
Critical (15%)	339	317	323	325	369	436	469	482	430	352	288	258

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance ^a												
10%	592	531	567	567	567	661	792	967	967	910	792	669
20%	538	493	567	565	566	656	792	967	967	828	732	600
30%	497	461	539	557	558	652	792	967	967	738	682	557
40%	451	426	498	540	553	646	792	967	933	664	607	521
50%	412	407	444	475	530	633	792	954	874	592	514	449
60%	354	392	416	444	496	621	790	861	761	521	455	402
70%	330	354	390	424	457	593	735	755	677	427	381	376
80%	296	307	349	365	415	542	630	661	549	380	357	332
90%	225	248	240	298	384	429	480	485	432	328	282	244
Long Term												
Full Simulation Period ^b	407	394	439	461	490	589	713	821	765	591	524	455
Water Year Types ^c												
Wet (32%)	454	435	514	518	515	632	785	951	941	800	712	576
Above Normal (16%)	377	380	429	513	531	640	787	946	887	621	552	477
Below Normal (13%)	446	431	467	484	533	619	757	843	780	527	472	453
Dry (24%)	394	383	408	423	479	579	691	760	658	495	443	419
Critical (15%)	324	305	315	320	366	432	475	486	415	327	267	231

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative minus Second Basis of Comparison												
Probability of Exceedance ^a												
10%	-97	-36	0	0	0	0	0	0	0	4	0	-81
20%	-45	-68	0	-2	-1	-1	0	0	0	11	48	-25
30%	-55	-67	-27	-6	-1	-2	0	0	2	10	44	-51
40%	-18	-73	-26	-15	-2	0	0	0	25	23	37	-1
50%	12	-23	-56	-48	-7	0	0	-5	67	45	46	17
60%	2	1	-40	-26	-2	0	0	3	16	17	13	-6
70%	-6	-1	-14	-6	0	-8	2	-6	47	-7	-6	9
80%	4	-27	-3	-22	-22	-21	-4	7	5	9	32	15
90%	-27	-11	-26	-13	-8	-26	-10	14	6	19	39	11
Long Term												
Full Simulation Period ^b	-24	-29	-18	-14	-4	-3	-1	-2	8	13	21	-16
Water Year Types ^c												
Wet (32%)	-29	-35	-8	-6	0	0	0	0	4	7	25	-70
Above Normal (16%)	-13	-33	-38	-24	-7	0	0	1	30	31	30	-8
Below Normal (13%)	-59	-58	-35	-30	-8	-7	-4	-4	41	52	64	66
Dry (24%)	-12	-16	-15	-14	-7	-6	-7	-9	-5	9	11	11
Critical (15%)	-14	-11	-9	-5	-3	-3	6	4	-16	-25	-21	-28

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-4-5. Folsom Lake, End of Month Storage

Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	689	567	567	567	567	661	792	967	967	906	792	750
20%	582	561	567	567	567	657	792	967	967	817	684	625
30%	552	528	566	563	559	653	792	967	965	728	638	608
40%	469	499	525	556	555	646	792	967	908	641	569	522
50%	400	430	500	523	537	633	792	959	807	546	468	433
60%	351	391	456	470	498	621	790	858	745	504	442	408
70%	336	356	405	430	457	601	733	761	630	433	387	366
80%	291	333	352	388	437	563	634	654	544	371	325	318
90%	253	259	266	311	392	455	489	471	426	309	244	233
Long Term												
Full Simulation Period ^b	431	424	457	475	494	592	715	823	757	579	503	471
Water Year Types ^c												
Wet (32%)	483	470	522	524	515	632	785	951	937	793	688	646
Above Normal (16%)	390	412	467	537	538	640	787	946	857	591	522	485
Below Normal (13%)	506	489	502	514	541	626	761	847	739	475	408	387
Dry (24%)	405	399	423	437	486	585	698	769	664	486	432	408
Critical (15%)	339	317	323	325	369	436	469	482	430	352	288	258

Alternative 3

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	688	567	567	567	567	661	792	967	967	921	792	751
20%	592	563	567	567	567	656	792	967	967	814	709	648
30%	548	537	564	564	560	652	792	967	958	726	647	605
40%	483	495	523	556	556	646	792	967	899	636	567	522
50%	396	432	502	520	545	633	792	957	793	546	465	429
60%	348	387	450	469	499	621	790	859	749	485	434	397
70%	329	358	405	431	457	603	734	758	655	431	381	366
80%	304	329	342	389	438	563	649	656	547	392	346	331
90%	259	260	251	297	384	446	484	479	428	312	285	290
Long Term												
Full Simulation Period ^b	432	424	456	474	493	591	714	822	755	580	508	473
Water Year Types ^c												
Wet (32%)	486	473	525	524	515	632	785	951	929	790	690	645
Above Normal (16%)	388	404	454	537	539	640	787	946	851	580	516	479
Below Normal (13%)	513	496	505	514	542	627	764	844	766	506	436	407
Dry (24%)	405	398	420	434	482	580	692	761	654	491	436	411
Critical (15%)	331	314	322	325	370	436	474	485	431	343	291	257

Alternative 3 minus Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-1	0	0	0	0	0	0	0	0	15	0	1
20%	10	3	0	0	0	-1	0	0	0	-3	24	23
30%	-4	9	-2	1	1	-1	0	0	-7	-2	9	-3
40%	13	-4	-1	1	1	0	0	0	-10	-5	-3	0
50%	-3	3	2	-3	9	0	0	-2	-14	0	-3	-3
60%	-4	-4	-5	-1	1	0	0	1	4	-19	-9	-11
70%	-7	2	0	1	0	1	0	-3	25	-2	-6	0
80%	13	-4	-10	1	1	0	15	2	3	21	22	14
90%	6	1	-15	-14	-8	-9	-5	8	2	4	41	56
Long Term												
Full Simulation Period ^b	0	0	-2	-1	-1	-1	0	-2	-2	2	5	2
Water Year Types ^c												
Wet (32%)	3	4	3	0	0	0	0	0	-8	-3	2	-1
Above Normal (16%)	-3	-9	-13	1	1	0	0	0	-6	-10	-7	-6
Below Normal (13%)	8	6	3	0	1	1	3	-3	27	31	28	21
Dry (24%)	-1	-1	-3	-3	-4	-4	-6	-7	-9	5	4	3
Critical (15%)	-7	-3	-1	0	1	0	5	3	1	-9	4	-1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-4-6. Folsom Lake, End of Month Storage

Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	689	567	567	567	567	661	792	967	967	906	792	750
20%	582	561	567	567	567	657	792	967	967	817	684	625
30%	552	528	566	563	559	653	792	967	965	728	638	608
40%	469	499	525	556	555	646	792	967	908	641	569	522
50%	400	430	500	523	537	633	792	959	807	546	468	433
60%	351	391	456	470	498	621	790	858	745	504	442	408
70%	336	356	405	430	457	601	733	761	630	433	387	366
80%	291	333	352	388	437	563	634	654	544	371	325	318
90%	253	259	266	311	392	455	489	471	426	309	244	233
Long Term												
Full Simulation Period ^b	431	424	457	475	494	592	715	823	757	579	503	471
Water Year Types ^c												
Wet (32%)	483	470	522	524	515	632	785	951	937	793	688	646
Above Normal (16%)	390	412	467	537	538	640	787	946	857	591	522	485
Below Normal (13%)	506	489	502	514	541	626	761	847	739	475	408	387
Dry (24%)	405	399	423	437	486	585	698	769	664	486	432	408
Critical (15%)	339	317	323	325	369	436	469	482	430	352	288	258

Alternative 5

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	592	533	567	567	567	661	792	967	967	869	792	665
20%	538	489	567	565	566	656	792	967	967	818	733	604
30%	503	463	537	557	558	652	792	967	967	738	664	559
40%	455	429	503	541	553	646	792	967	933	665	608	521
50%	412	409	444	479	530	633	792	965	874	595	514	449
60%	353	392	417	448	496	621	790	861	773	524	460	401
70%	329	353	400	422	450	593	736	756	682	432	386	364
80%	294	314	350	370	412	542	626	665	552	383	349	333
90%	227	249	239	299	381	432	484	498	430	331	285	248
Long Term												
Full Simulation Period ^b	407	394	439	461	490	590	715	825	766	587	520	453
Water Year Types ^c												
Wet (32%)	454	435	515	518	515	632	785	952	941	794	710	577
Above Normal (16%)	375	379	428	513	532	640	787	946	888	622	554	478
Below Normal (13%)	440	425	461	483	534	620	758	845	783	523	469	450
Dry (24%)	397	386	411	426	479	579	691	766	664	489	435	410
Critical (15%)	325	304	314	320	367	433	483	499	411	324	257	231

Alternative 5 minus Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-97	-34	0	0	0	0	0	0	0	-37	0	-85
20%	-44	-72	0	-2	-1	-1	0	0	0	1	49	-21
30%	-49	-65	-29	-6	-1	-2	0	0	0	2	10	-49
40%	-15	-70	-22	-15	-2	0	0	0	25	24	38	0
50%	13	-21	-56	-44	-7	0	0	5	67	49	46	16
60%	2	1	-39	-21	-2	0	0	3	27	20	18	-7
70%	-7	-3	-4	-8	-8	-8	3	-5	52	-1	-1	-2
80%	3	-19	-3	-18	-25	-21	-8	11	8	11	24	15
90%	-26	-10	-27	-13	-12	-23	-5	27	4	22	41	14
Long Term												
Full Simulation Period ^b	-25	-30	-18	-13	-4	-3	0	2	9	9	16	-18
Water Year Types ^c												
Wet (32%)	-29	-35	-8	-6	0	0	0	0	4	1	23	-69
Above Normal (16%)	-16	-34	-39	-24	-6	0	0	1	30	32	32	-7
Below Normal (13%)	-66	-65	-41	-31	-7	-7	-3	-2	44	49	60	63
Dry (24%)	-9	-13	-12	-12	-7	-5	-7	-3	0	4	3	2
Critical (15%)	-14	-12	-9	-5	-2	-3	14	17	-19	-28	-31	-27

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 **C.5. San Luis Storage**

Figure C-5-1-1. San Luis Reservoir (SWP and CVP), End of May Storage

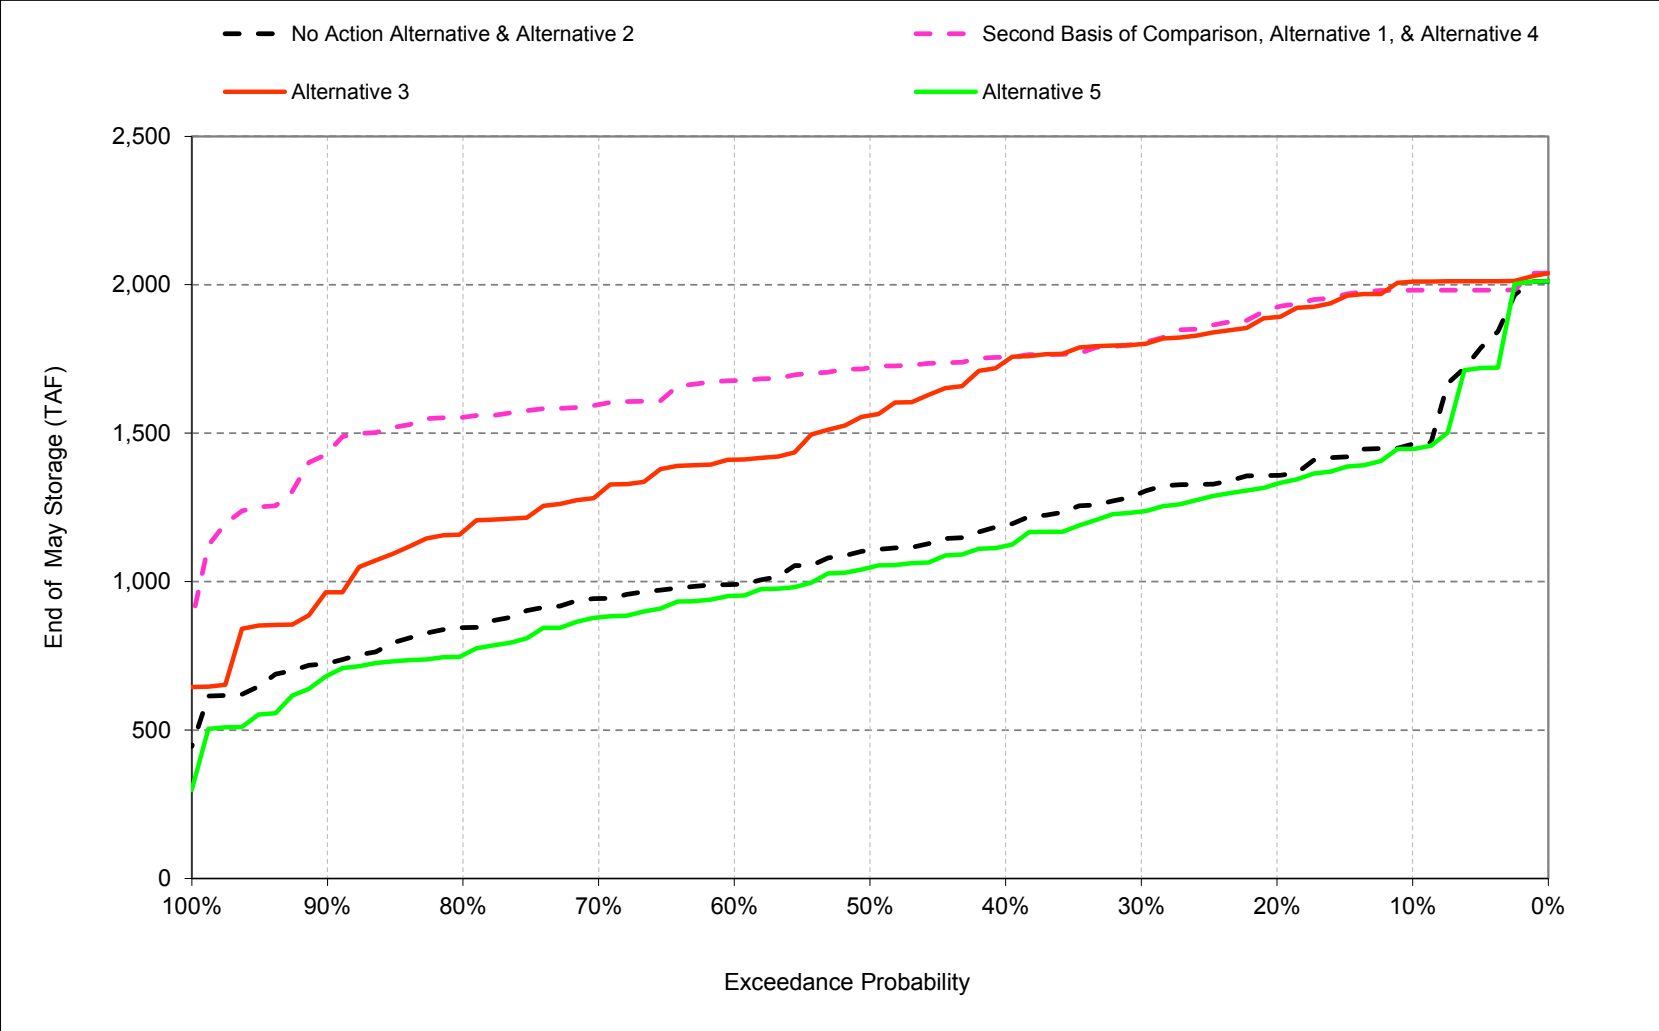


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-5-1-2. San Luis Reservoir (SWP and CVP), End of August Storage

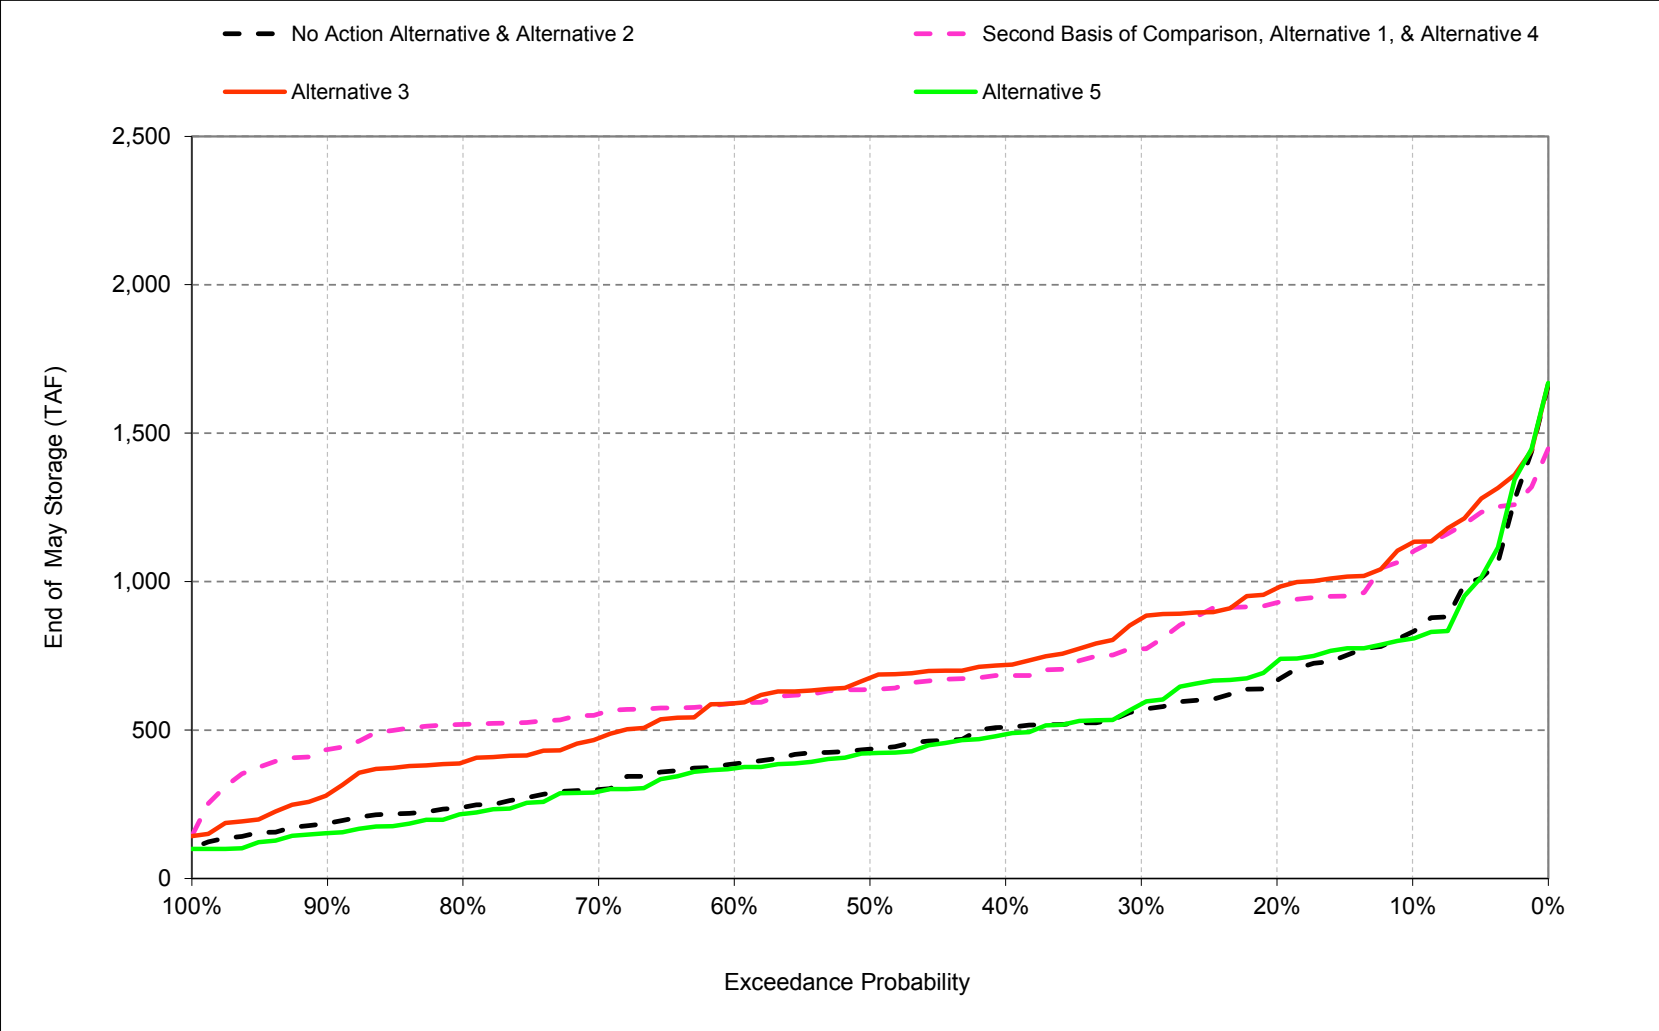

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-5-1-3. San Luis Reservoir (SWP and CVP), End of September Storage

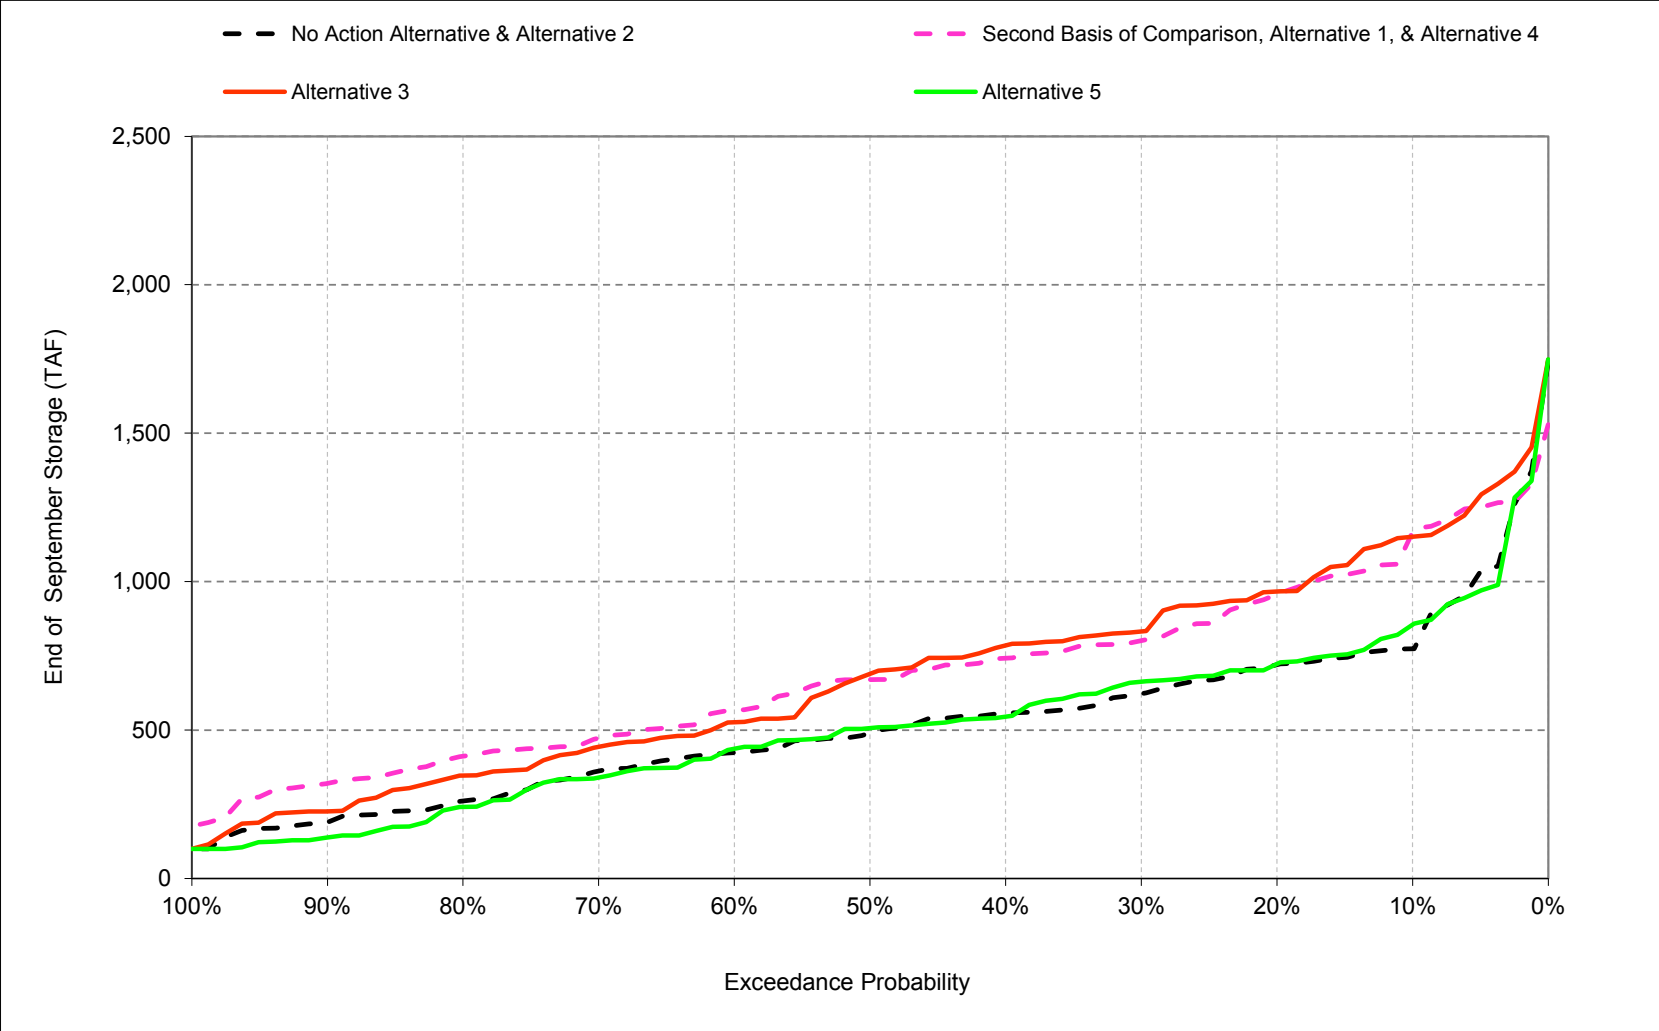

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-5-1-1. San Luis Reservoir (SWP and CVP), End of Month Storage

No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	868	1,032	1,320	1,726	2,029	2,039	1,835	1,463	1,167	970	831	774
20%	728	849	1,157	1,388	1,643	1,898	1,742	1,358	1,024	868	667	720
30%	563	739	1,076	1,328	1,582	1,801	1,620	1,300	915	780	568	623
40%	503	663	979	1,269	1,504	1,716	1,542	1,190	804	670	509	557
50%	471	580	817	1,140	1,410	1,622	1,457	1,106	714	561	436	491
60%	418	484	742	1,016	1,267	1,507	1,358	991	665	489	386	424
70%	334	422	698	969	1,154	1,314	1,218	943	606	435	299	362
80%	276	356	603	808	1,046	1,267	1,119	845	498	354	240	261
90%	206	298	463	751	941	1,087	1,021	724	378	303	186	190
Long Term												
Full Simulation Period ^b	510	628	890	1,171	1,391	1,575	1,431	1,128	793	642	491	521
Water Year Types^c												
Wet (32%)	555	681	931	1,236	1,526	1,788	1,598	1,251	946	741	628	679
Above Normal (16%)	490	649	957	1,223	1,441	1,661	1,444	1,048	666	466	433	513
Below Normal (13%)	525	624	907	1,141	1,314	1,473	1,312	967	555	500	426	467
Dry (24%)	476	590	867	1,150	1,339	1,494	1,413	1,167	840	763	476	469
Critical (15%)	478	556	752	1,040	1,204	1,252	1,192	1,028	739	544	343	323

Alternative 1												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,176	1,436	1,728	2,026	2,039	2,039	2,039	1,981	1,738	1,367	1,100	1,166
20%	994	1,178	1,546	1,886	2,039	2,039	2,039	1,924	1,557	1,212	929	957
30%	864	1,071	1,412	1,838	2,036	2,039	2,039	1,804	1,476	1,128	774	801
40%	811	1,013	1,271	1,685	1,993	2,039	2,039	1,756	1,352	1,025	684	742
50%	715	889	1,152	1,616	1,938	2,039	2,023	1,721	1,302	942	637	670
60%	588	750	1,063	1,519	1,877	2,039	1,951	1,677	1,249	901	590	567
70%	461	659	971	1,467	1,805	1,972	1,880	1,596	1,209	852	554	473
80%	356	556	861	1,310	1,671	1,867	1,828	1,553	1,164	815	519	412
90%	268	363	660	1,175	1,508	1,718	1,741	1,433	1,066	751	435	321
Long Term												
Full Simulation Period ^b	711	895	1,180	1,585	1,831	1,941	1,910	1,697	1,338	1,000	705	687
Water Year Types^c												
Wet (32%)	790	1,017	1,365	1,748	1,965	2,033	2,031	1,852	1,487	1,167	889	925
Above Normal (16%)	658	883	1,213	1,671	1,913	2,001	1,995	1,717	1,263	861	612	631
Below Normal (13%)	854	1,064	1,334	1,742	1,908	1,980	1,908	1,628	1,251	964	635	591
Dry (24%)	617	764	998	1,427	1,728	1,925	1,870	1,665	1,341	1,007	660	596
Critical (15%)	622	709	910	1,257	1,556	1,664	1,623	1,451	1,168	808	545	472

Alternative 1 minus No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	308	404	408	300	10	0	204	519	571	397	269	392
20%	265	329	389	498	396	141	297	567	533	345	262	237
30%	301	332	335	510	454	238	419	505	561	348	206	178
40%	308	350	292	416	489	323	497	565	548	355	175	186
50%	244	310	334	476	528	417	566	616	589	382	201	179
60%	170	266	321	503	610	532	593	686	584	413	204	143
70%	127	237	273	497	651	658	663	653	603	418	255	111
80%	80	200	257	502	625	600	709	709	666	461	279	151
90%	62	65	196	424	567	632	720	709	688	449	249	131
Long Term												
Full Simulation Period ^b	200	267	290	414	440	365	479	569	545	358	214	166
Water Year Types^c												
Wet (32%)	234	336	433	513	439	245	433	601	541	426	261	245
Above Normal (16%)	168	234	257	448	471	341	551	669	598	395	179	117
Below Normal (13%)	329	439	427	601	594	507	596	660	696	465	209	124
Dry (24%)	141	174	130	277	390	431	457	498	501	244	185	127
Critical (15%)	144	153	158	217	352	412	431	423	429	263	202	149

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-5-1-2. San Luis Reservoir (SWP and CVP), End of Month Storage

No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	868	1,032	1,320	1,726	2,029	2,039	1,835	1,463	1,167	970	831	774
20%	728	849	1,157	1,388	1,643	1,898	1,742	1,358	1,024	868	667	720
30%	563	739	1,076	1,328	1,582	1,801	1,620	1,300	915	780	568	623
40%	503	663	979	1,269	1,504	1,716	1,542	1,190	804	670	509	557
50%	471	580	817	1,140	1,410	1,622	1,457	1,106	714	561	436	491
60%	418	484	742	1,016	1,267	1,507	1,358	991	665	489	386	424
70%	334	422	698	969	1,154	1,314	1,218	943	606	435	299	362
80%	276	356	603	808	1,046	1,267	1,119	845	498	354	240	261
90%	206	298	463	751	941	1,087	1,021	724	378	303	186	190
Long Term												
Full Simulation Period ^b	510	628	890	1,171	1,391	1,575	1,431	1,128	793	642	491	521
Water Year Types^c												
Wet (32%)	555	681	931	1,236	1,526	1,788	1,598	1,251	946	741	628	679
Above Normal (16%)	490	649	957	1,223	1,441	1,661	1,444	1,048	666	466	433	513
Below Normal (13%)	525	624	907	1,141	1,314	1,473	1,312	967	555	500	426	467
Dry (24%)	476	590	867	1,150	1,339	1,494	1,413	1,167	840	763	476	469
Critical (15%)	478	556	752	1,040	1,204	1,252	1,192	1,028	739	544	343	323

Alternative 3												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,237	1,441	1,675	1,889	2,039	2,039	2,039	2,011	1,684	1,427	1,132	1,151
20%	985	1,234	1,446	1,710	1,955	2,039	2,036	1,891	1,541	1,256	978	967
30%	901	1,067	1,324	1,581	1,824	2,033	2,004	1,800	1,402	1,133	875	832
40%	801	981	1,253	1,488	1,697	1,903	1,961	1,742	1,331	986	720	785
50%	722	869	1,124	1,383	1,609	1,815	1,770	1,560	1,165	920	676	689
60%	537	765	1,025	1,313	1,501	1,702	1,670	1,411	1,040	806	590	527
70%	377	666	925	1,209	1,436	1,599	1,545	1,295	959	706	473	444
80%	317	491	775	1,066	1,277	1,409	1,397	1,168	837	591	391	347
90%	232	359	605	872	1,003	1,167	1,194	964	614	465	283	227
Long Term												
Full Simulation Period ^b	702	890	1,130	1,381	1,573	1,708	1,695	1,517	1,190	929	690	679
Water Year Types^c												
Wet (32%)	810	1,033	1,276	1,555	1,810	1,957	1,975	1,851	1,540	1,228	961	980
Above Normal (16%)	619	844	1,109	1,342	1,571	1,756	1,763	1,575	1,155	830	674	703
Below Normal (13%)	834	1,043	1,305	1,489	1,623	1,736	1,651	1,338	899	737	585	561
Dry (24%)	634	804	1,052	1,302	1,455	1,608	1,593	1,413	1,128	926	590	535
Critical (15%)	548	632	804	1,076	1,216	1,256	1,227	1,069	838	572	380	351

Alternative 3 minus No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	369	409	355	163	10	0	204	548	517	457	301	377
20%	257	384	289	323	312	141	294	534	518	388	311	246
30%	338	328	248	253	243	233	383	500	487	353	307	209
40%	297	318	274	219	193	187	419	552	527	316	210	229
50%	251	289	307	243	200	193	313	454	452	360	240	198
60%	119	281	284	297	234	195	312	420	375	317	204	102
70%	43	244	227	240	282	286	328	352	354	271	173	81
80%	41	135	172	258	231	142	278	323	339	237	151	86
90%	26	61	142	121	63	80	172	239	236	162	97	37
Long Term												
Full Simulation Period ^b	192	262	240	210	182	133	265	389	397	288	199	158
Water Year Types^c												
Wet (32%)	255	351	345	320	284	170	377	599	593	487	334	300
Above Normal (16%)	130	194	153	119	129	95	319	526	489	363	241	190
Below Normal (13%)	309	419	399	348	309	263	339	371	344	237	160	94
Dry (24%)	158	214	185	152	117	114	180	246	288	163	114	66
Critical (15%)	70	76	53	37	12	4	35	40	99	28	38	28

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-5-1-3. San Luis Reservoir (SWP and CVP), End of Month Storage

No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	868	1,032	1,320	1,726	2,029	2,039	1,835	1,463	1,167	970	831	774
20%	728	849	1,157	1,388	1,643	1,898	1,742	1,358	1,024	868	667	720
30%	563	739	1,076	1,328	1,582	1,801	1,620	1,300	915	780	568	623
40%	503	663	979	1,269	1,504	1,716	1,542	1,190	804	670	509	557
50%	471	580	817	1,140	1,410	1,622	1,457	1,106	714	561	436	491
60%	418	484	742	1,016	1,267	1,507	1,358	991	665	489	386	424
70%	334	422	698	969	1,154	1,314	1,218	943	606	435	299	362
80%	276	356	603	808	1,046	1,267	1,119	845	498	354	240	261
90%	206	298	463	751	941	1,087	1,021	724	378	303	186	190
Long Term												
Full Simulation Period ^b	510	628	890	1,171	1,391	1,575	1,431	1,128	793	642	491	521
Water Year Types ^c												
Wet (32%)	555	681	931	1,236	1,526	1,788	1,598	1,251	946	741	628	679
Above Normal (16%)	490	649	957	1,223	1,441	1,661	1,444	1,048	666	466	433	513
Below Normal (13%)	525	624	907	1,141	1,314	1,473	1,312	967	555	500	426	467
Dry (24%)	476	590	867	1,150	1,339	1,494	1,413	1,167	840	763	476	469
Critical (15%)	478	556	752	1,040	1,204	1,252	1,192	1,028	739	544	343	323

Alternative 5												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	835	982	1,306	1,593	2,000	2,039	1,821	1,448	1,216	972	808	855
20%	709	874	1,139	1,403	1,658	1,921	1,727	1,329	1,009	879	731	723
30%	610	740	1,046	1,334	1,596	1,824	1,609	1,236	875	755	588	663
40%	540	656	993	1,238	1,494	1,723	1,509	1,120	718	613	485	545
50%	487	589	880	1,137	1,399	1,614	1,416	1,048	689	544	422	507
60%	417	510	743	1,044	1,285	1,490	1,300	953	622	454	371	437
70%	314	423	705	975	1,175	1,382	1,203	880	523	400	293	341
80%	266	348	592	833	1,062	1,275	1,114	753	445	311	217	241
90%	192	260	455	759	932	1,045	926	684	356	269	153	138
Long Term												
Full Simulation Period ^b	508	620	886	1,167	1,390	1,575	1,404	1,069	745	611	483	516
Water Year Types ^c												
Wet (32%)	576	706	958	1,251	1,539	1,804	1,624	1,279	984	787	680	726
Above Normal (16%)	488	622	932	1,213	1,440	1,660	1,447	1,046	672	477	442	520
Below Normal (13%)	541	628	923	1,157	1,335	1,496	1,305	928	524	476	414	463
Dry (24%)	464	572	856	1,139	1,327	1,481	1,324	1,002	691	655	412	418
Critical (15%)	429	505	698	994	1,166	1,216	1,103	875	600	428	284	270

Alternative 5 minus No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-33	-50	-14	-133	-28	0	-14	-15	49	2	-23	80
20%	-19	25	-18	15	15	23	-15	-28	-15	11	64	3
30%	47	1	-30	6	14	24	-11	-64	-39	-25	20	40
40%	37	-6	13	-31	-10	7	-33	-70	-86	-57	-24	-11
50%	16	9	63	-2	-10	-8	-41	-58	-25	-17	-14	16
60%	-1	26	1	28	18	-16	-58	-38	-43	-35	-15	13
70%	-20	1	6	6	21	69	-15	-63	-83	-35	-6	-22
80%	-10	-8	-12	25	16	8	-5	-92	-53	-43	-23	-20
90%	-15	-38	-8	8	-9	-42	-95	-40	-22	-34	-33	-51
Long Term												
Full Simulation Period ^b	-2	-8	-4	-4	-2	0	-27	-59	-48	-30	-8	-5
Water Year Types ^c												
Wet (32%)	20	25	27	15	13	16	26	28	38	46	52	47
Above Normal (16%)	-2	-27	-24	-10	-2	-1	3	-2	6	10	8	7
Below Normal (13%)	16	4	16	17	21	23	-7	-39	-31	-24	-12	-4
Dry (24%)	-12	-18	-11	-11	-12	-13	-89	-165	-149	-107	-64	-51
Critical (15%)	-50	-51	-53	-46	-38	-36	-89	-154	-140	-116	-59	-53

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-5-1-4. San Luis Reservoir (SWP and CVP), End of Month Storage

Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1,176	1,436	1,728	2,026	2,039	2,039	2,039	1,981	1,738	1,367	1,100	1,166
20%	994	1,178	1,546	1,886	2,039	2,039	2,039	1,924	1,557	1,212	929	957
30%	864	1,071	1,412	1,838	2,036	2,039	2,039	1,804	1,476	1,128	774	801
40%	811	1,013	1,271	1,685	1,993	2,039	2,039	1,756	1,352	1,025	684	742
50%	715	889	1,152	1,616	1,938	2,039	2,023	1,721	1,302	942	637	670
60%	588	750	1,063	1,519	1,877	2,039	1,951	1,677	1,249	901	590	567
70%	461	659	971	1,467	1,805	1,972	1,880	1,596	1,209	852	554	473
80%	356	556	861	1,310	1,671	1,867	1,828	1,553	1,164	815	519	412
90%	268	363	660	1,175	1,508	1,718	1,741	1,433	1,066	751	435	321
Long Term												
Full Simulation Period ^b	711	895	1,180	1,585	1,831	1,941	1,910	1,697	1,338	1,000	705	687
Water Year Types ^c												
Wet (32%)	790	1,017	1,365	1,748	1,965	2,033	2,031	1,852	1,487	1,167	889	925
Above Normal (16%)	658	883	1,213	1,671	1,913	2,001	1,995	1,717	1,263	861	612	631
Below Normal (13%)	854	1,064	1,334	1,742	1,908	1,980	1,908	1,628	1,251	964	635	591
Dry (24%)	617	764	998	1,427	1,728	1,925	1,870	1,665	1,341	1,007	660	596
Critical (15%)	622	709	910	1,257	1,556	1,664	1,623	1,451	1,168	808	545	472

No Action Alternative

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	868	1,032	1,320	1,726	2,029	2,039	1,835	1,463	1,167	970	831	774
20%	728	849	1,157	1,388	1,643	1,898	1,742	1,358	1,024	868	667	720
30%	563	739	1,076	1,328	1,582	1,801	1,620	1,300	915	780	568	623
40%	503	663	979	1,269	1,504	1,716	1,542	1,190	804	670	509	557
50%	471	580	817	1,140	1,410	1,622	1,457	1,106	714	561	436	491
60%	418	484	742	1,016	1,267	1,507	1,358	991	665	489	386	424
70%	334	422	698	969	1,154	1,314	1,218	943	606	435	299	362
80%	276	356	603	808	1,046	1,267	1,119	845	498	354	240	261
90%	206	298	463	751	941	1,087	1,021	724	378	303	186	190
Long Term												
Full Simulation Period ^b	510	628	890	1,171	1,391	1,575	1,431	1,128	793	642	491	521
Water Year Types ^c												
Wet (32%)	555	681	931	1,236	1,526	1,788	1,598	1,251	946	741	628	679
Above Normal (16%)	490	649	957	1,223	1,441	1,661	1,444	1,048	666	466	433	513
Below Normal (13%)	525	624	907	1,141	1,314	1,473	1,312	967	555	500	426	467
Dry (24%)	476	590	867	1,150	1,339	1,494	1,413	1,167	840	763	476	469
Critical (15%)	478	556	752	1,040	1,204	1,252	1,192	1,028	739	544	343	323

No Action Alternative minus Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-308	-404	-408	-300	-10	0	-204	-519	-571	-397	-269	-392
20%	-265	-329	-389	-498	-396	-141	-297	-567	-533	-345	-262	-237
30%	-301	-332	-335	-510	-454	-238	-419	-505	-561	-348	-206	-178
40%	-308	-350	-292	-416	-489	-323	-497	-565	-548	-355	-175	-186
50%	-244	-310	-334	-476	-528	-417	-566	-616	-589	-382	-201	-179
60%	-170	-266	-321	-503	-610	-532	-593	-686	-584	-413	-204	-143
70%	-127	-237	-273	-497	-651	-658	-663	-653	-603	-418	-255	-111
80%	-80	-200	-257	-502	-625	-600	-709	-709	-666	-461	-279	-151
90%	-62	-65	-196	-424	-567	-632	-720	-709	-688	-449	-249	-131
Long Term												
Full Simulation Period ^b	-200	-267	-290	-414	-440	-365	-479	-569	-545	-358	-214	-166
Water Year Types ^c												
Wet (32%)	-234	-336	-433	-513	-439	-245	-433	-601	-541	-426	-261	-245
Above Normal (16%)	-168	-234	-257	-448	-471	-341	-551	-669	-598	-395	-179	-117
Below Normal (13%)	-329	-439	-427	-601	-594	-507	-596	-660	-696	-465	-209	-124
Dry (24%)	-141	-174	-130	-277	-390	-431	-457	-498	-501	-244	-185	-127
Critical (15%)	-144	-153	-158	-217	-352	-412	-431	-423	-429	-263	-202	-149

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-5-1-5. San Luis Reservoir (SWP and CVP), End of Month Storage

Second Basis of Comparison												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,176	1,436	1,728	2,026	2,039	2,039	2,039	1,981	1,738	1,367	1,100	1,166
20%	994	1,178	1,546	1,886	2,039	2,039	2,039	1,924	1,557	1,212	929	957
30%	864	1,071	1,412	1,838	2,036	2,039	2,039	1,804	1,476	1,128	774	801
40%	811	1,013	1,271	1,685	1,993	2,039	2,039	1,756	1,352	1,025	684	742
50%	715	889	1,152	1,616	1,938	2,039	2,023	1,721	1,302	942	637	670
60%	588	750	1,063	1,519	1,877	2,039	1,951	1,677	1,249	901	590	567
70%	461	659	971	1,467	1,805	1,972	1,880	1,596	1,209	852	554	473
80%	356	556	861	1,310	1,671	1,867	1,828	1,553	1,164	815	519	412
90%	268	363	660	1,175	1,508	1,718	1,741	1,433	1,066	751	435	321
Long Term												
Full Simulation Period ^b	711	895	1,180	1,585	1,831	1,941	1,910	1,697	1,338	1,000	705	687
Water Year Types^c												
Wet (32%)	790	1,017	1,365	1,748	1,965	2,033	2,031	1,852	1,487	1,167	889	925
Above Normal (16%)	658	883	1,213	1,671	1,913	2,001	1,995	1,717	1,263	861	612	631
Below Normal (13%)	854	1,064	1,334	1,742	1,908	1,980	1,908	1,628	1,251	964	635	591
Dry (24%)	617	764	998	1,427	1,728	1,925	1,870	1,665	1,341	1,007	660	596
Critical (15%)	622	709	910	1,257	1,556	1,664	1,623	1,451	1,168	808	545	472

Alternative 3												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,237	1,441	1,675	1,889	2,039	2,039	2,039	2,011	1,684	1,427	1,132	1,151
20%	985	1,234	1,446	1,710	1,955	2,039	2,036	1,891	1,541	1,256	978	967
30%	901	1,067	1,324	1,581	1,824	2,033	2,004	1,800	1,402	1,133	875	832
40%	801	981	1,253	1,488	1,697	1,903	1,961	1,742	1,331	986	720	785
50%	722	869	1,124	1,383	1,609	1,815	1,770	1,560	1,165	920	676	689
60%	537	765	1,025	1,313	1,501	1,702	1,670	1,411	1,040	806	590	527
70%	377	666	925	1,209	1,436	1,599	1,545	1,295	959	706	473	444
80%	317	491	775	1,066	1,277	1,409	1,397	1,168	837	591	391	347
90%	232	359	605	872	1,003	1,167	1,194	964	614	465	283	227
Long Term												
Full Simulation Period ^b	702	890	1,130	1,381	1,573	1,708	1,695	1,517	1,190	929	690	679
Water Year Types^c												
Wet (32%)	810	1,033	1,276	1,555	1,810	1,957	1,975	1,851	1,540	1,228	961	980
Above Normal (16%)	619	844	1,109	1,342	1,571	1,756	1,763	1,575	1,155	830	674	703
Below Normal (13%)	834	1,043	1,305	1,489	1,623	1,736	1,651	1,338	899	737	585	561
Dry (24%)	634	804	1,052	1,302	1,455	1,608	1,593	1,413	1,128	926	590	535
Critical (15%)	548	632	804	1,076	1,216	1,256	1,227	1,069	838	572	380	351

Alternative 3 minus Second Basis of Comparison												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	61	5	-53	-137	0	0	0	29	-54	60	32	-15
20%	-9	56	-100	-176	-84	0	-3	-33	-15	43	48	9
30%	37	-4	-88	-257	-212	-6	-35	-4	-74	5	102	31
40%	-11	-32	-18	-197	-296	-136	-78	-14	-21	-39	36	43
50%	7	-20	-27	-232	-329	-224	-253	-162	-137	-22	39	19
60%	-50	16	-38	-206	-376	-337	-281	-266	-209	-95	0	-40
70%	-84	7	-46	-257	-369	-373	-335	-301	-250	-146	-82	-30
80%	-39	-65	-85	-245	-394	-459	-431	-385	-327	-225	-128	-65
90%	-36	-5	-55	-302	-504	-552	-548	-469	-452	-286	-152	-94
Long Term												
Full Simulation Period ^b	-9	-6	-50	-204	-258	-233	-215	-180	-148	-70	-15	-8
Water Year Types^c												
Wet (32%)	21	16	-88	-193	-155	-76	-56	-2	53	61	72	55
Above Normal (16%)	-38	-40	-104	-329	-342	-245	-233	-143	-108	-32	63	73
Below Normal (13%)	-20	-20	-29	-253	-285	-244	-257	-290	-352	-227	-50	-30
Dry (24%)	17	40	55	-125	-273	-317	-277	-252	-214	-81	-70	-61
Critical (15%)	-74	-77	-106	-180	-340	-408	-396	-383	-330	-235	-164	-121

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-5-1-6. San Luis Reservoir (SWP and CVP), End of Month Storage

Second Basis of Comparison												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,176	1,436	1,728	2,026	2,039	2,039	2,039	1,981	1,738	1,367	1,100	1,166
20%	994	1,178	1,546	1,886	2,039	2,039	2,039	1,924	1,557	1,212	929	957
30%	864	1,071	1,412	1,838	2,036	2,039	2,039	1,804	1,476	1,128	774	801
40%	811	1,013	1,271	1,685	1,993	2,039	2,039	1,756	1,352	1,025	684	742
50%	715	889	1,152	1,616	1,938	2,039	2,023	1,721	1,302	942	637	670
60%	588	750	1,063	1,519	1,877	2,039	1,951	1,677	1,249	901	590	567
70%	461	659	971	1,467	1,805	1,972	1,880	1,596	1,209	852	554	473
80%	356	556	861	1,310	1,671	1,867	1,828	1,553	1,164	815	519	412
90%	268	363	660	1,175	1,508	1,718	1,741	1,433	1,066	751	435	321
Long Term												
Full Simulation Period ^b	711	895	1,180	1,585	1,831	1,941	1,910	1,697	1,338	1,000	705	687
Water Year Types^c												
Wet (32%)	790	1,017	1,365	1,748	1,965	2,033	2,031	1,852	1,487	1,167	889	925
Above Normal (16%)	658	883	1,213	1,671	1,913	2,001	1,995	1,717	1,263	861	612	631
Below Normal (13%)	854	1,064	1,334	1,742	1,908	1,980	1,908	1,628	1,251	964	635	591
Dry (24%)	617	764	998	1,427	1,728	1,925	1,870	1,665	1,341	1,007	660	596
Critical (15%)	622	709	910	1,257	1,556	1,664	1,623	1,451	1,168	808	545	472

Alternative 5

Alternative 5												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	835	982	1,306	1,593	2,000	2,039	1,821	1,448	1,216	972	808	855
20%	709	874	1,139	1,403	1,658	1,921	1,727	1,329	1,009	879	731	723
30%	610	740	1,046	1,334	1,596	1,824	1,609	1,236	875	755	588	663
40%	540	656	993	1,238	1,494	1,723	1,509	1,120	718	613	485	545
50%	487	589	880	1,137	1,399	1,614	1,416	1,048	689	544	422	507
60%	417	510	743	1,044	1,285	1,490	1,300	953	622	454	371	437
70%	314	423	705	975	1,175	1,382	1,203	880	523	400	293	341
80%	266	348	592	833	1,062	1,275	1,114	753	445	311	217	241
90%	192	260	455	759	932	1,045	926	684	356	269	153	138
Long Term												
Full Simulation Period ^b	508	620	886	1,167	1,390	1,575	1,404	1,069	745	611	483	516
Water Year Types^c												
Wet (32%)	576	706	958	1,251	1,539	1,804	1,624	1,279	984	787	680	726
Above Normal (16%)	488	622	932	1,213	1,440	1,660	1,447	1,046	672	477	442	520
Below Normal (13%)	541	628	923	1,157	1,335	1,496	1,305	928	524	476	414	463
Dry (24%)	464	572	856	1,139	1,327	1,481	1,324	1,002	691	655	412	418
Critical (15%)	429	505	698	994	1,166	1,216	1,103	875	600	428	284	270

Alternative 5 minus Second Basis of Comparison

Alternative 5 minus Second Basis of Comparison												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-341	-454	-423	-434	-39	0	-218	-534	-522	-395	-292	-312
20%	-285	-304	-407	-483	-381	-118	-312	-595	-548	-334	-199	-235
30%	-254	-331	-366	-503	-440	-215	-430	-568	-601	-372	-186	-138
40%	-271	-356	-278	-447	-499	-316	-530	-636	-634	-412	-199	-197
50%	-229	-300	-272	-478	-539	-425	-607	-674	-613	-398	-214	-163
60%	-170	-240	-320	-475	-592	-549	-651	-724	-627	-448	-219	-130
70%	-147	-236	-266	-491	-631	-589	-677	-716	-686	-452	-261	-133
80%	-90	-208	-269	-478	-609	-593	-714	-801	-719	-504	-302	-171
90%	-76	-104	-204	-416	-576	-674	-815	-749	-710	-483	-282	-183
Long Term												
Full Simulation Period ^b	-202	-275	-294	-418	-442	-366	-506	-628	-592	-388	-222	-171
Water Year Types^c												
Wet (32%)	-214	-311	-407	-498	-426	-229	-408	-573	-503	-380	-210	-199
Above Normal (16%)	-170	-261	-281	-458	-473	-342	-548	-671	-591	-385	-170	-111
Below Normal (13%)	-313	-435	-411	-584	-572	-483	-603	-699	-727	-489	-221	-128
Dry (24%)	-153	-192	-141	-289	-402	-444	-546	-663	-650	-352	-249	-178
Critical (15%)	-193	-204	-212	-263	-390	-448	-520	-577	-569	-379	-261	-202


^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-5-2-1. San Luis Reservoir (CVP), End of May Storage

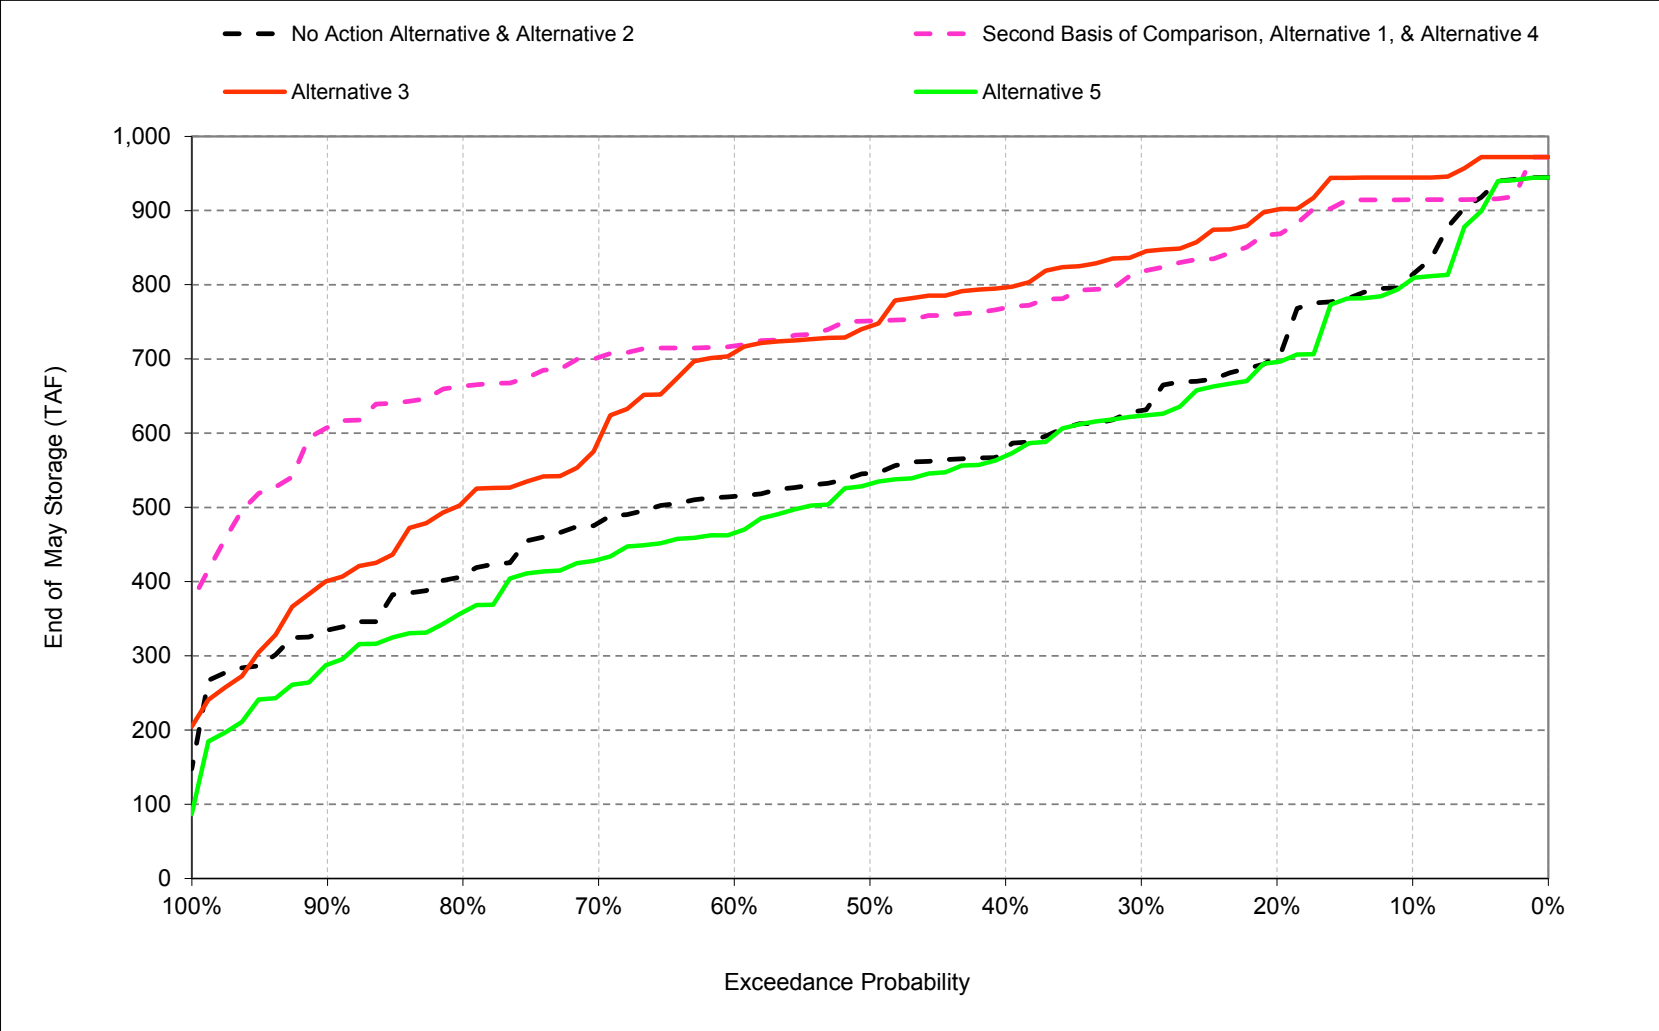


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-5-2-2. San Luis Reservoir (CVP), End of August Storage

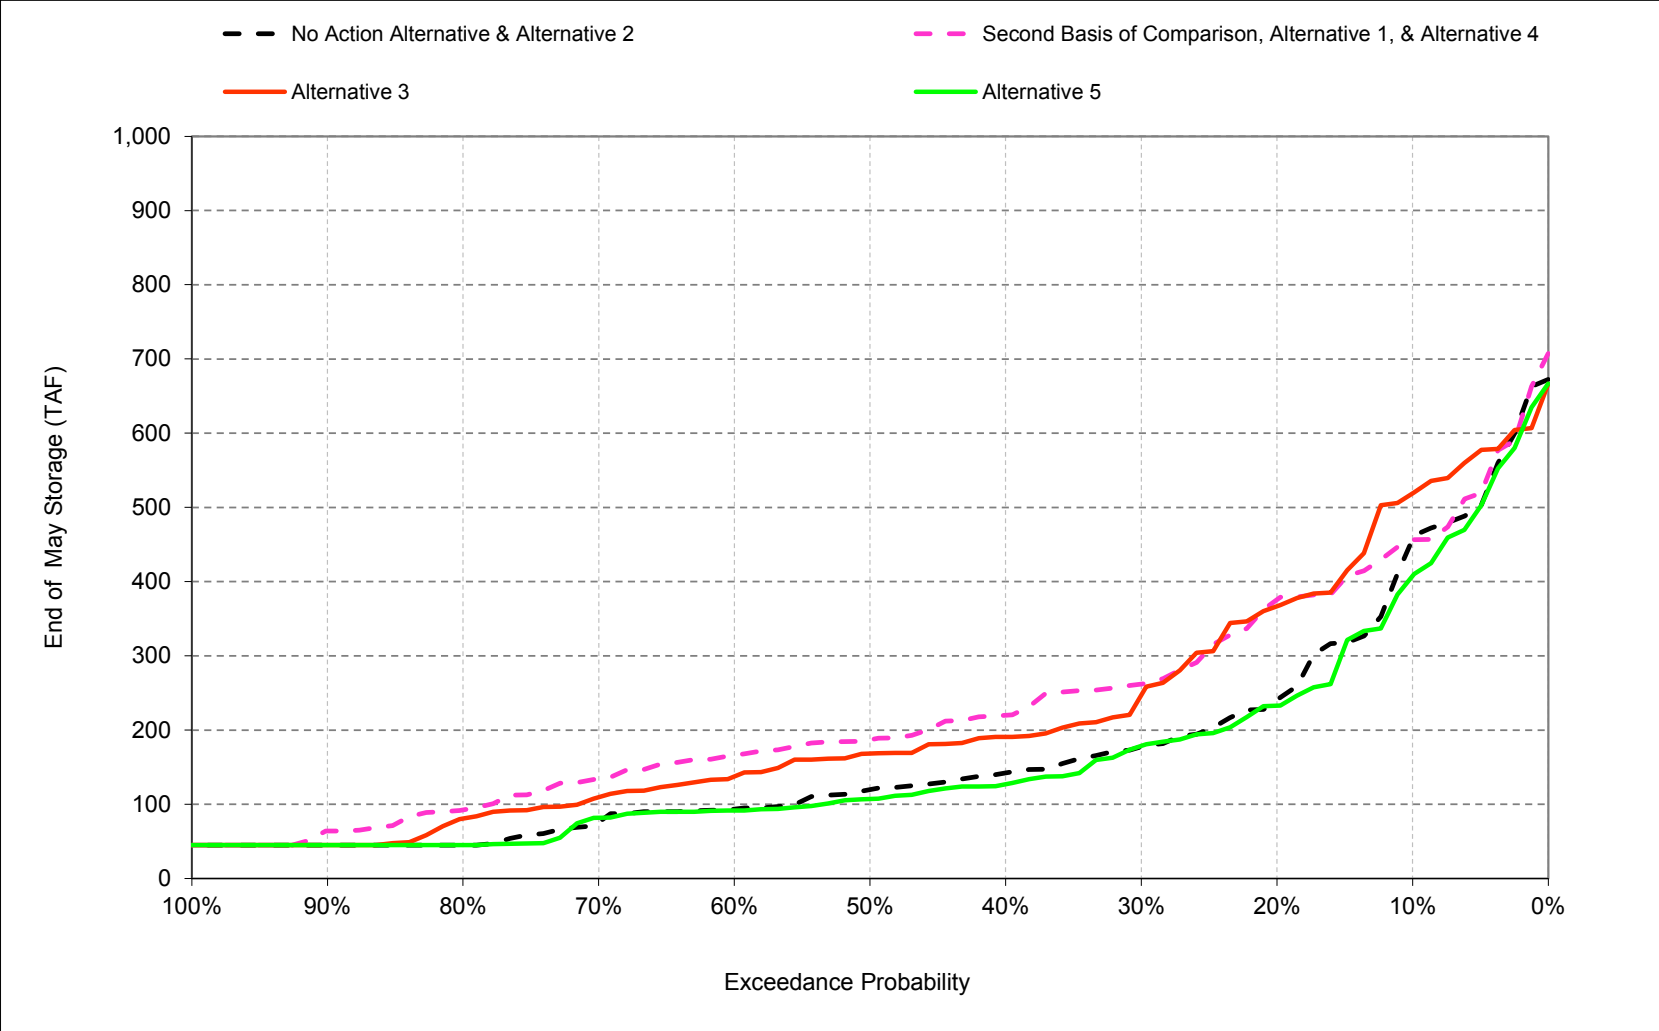

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-5-2-3. San Luis Reservoir (CVP), End of September Storage

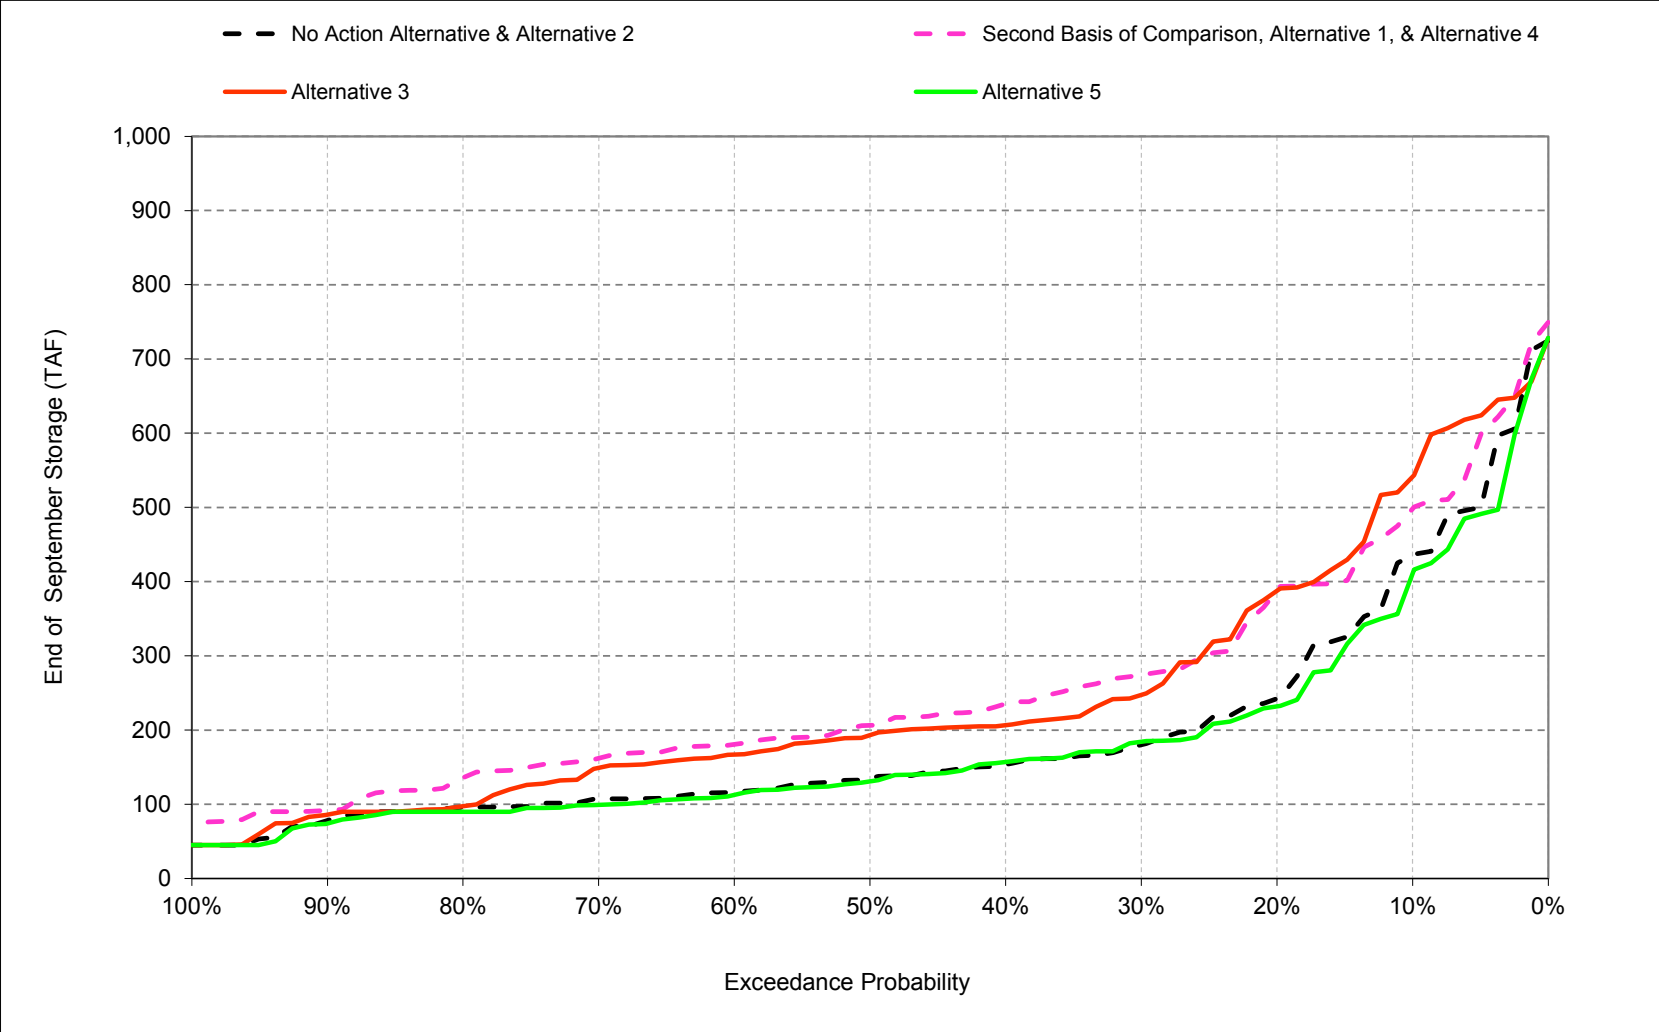

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-5-2-1. San Luis Reservoir (CVP), End of Month Storage

No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	408	488	706	888	972	972	921	814	690	505	457	436
20%	278	373	573	741	904	972	870	703	603	403	241	242
30%	233	367	553	684	798	930	830	630	464	303	178	180
40%	201	367	544	660	762	861	768	579	387	283	142	154
50%	183	350	512	622	728	808	707	546	365	231	120	135
60%	175	324	493	599	666	758	681	515	337	170	93	116
70%	160	283	454	575	610	704	626	479	286	135	76	107
80%	136	244	386	526	561	615	552	408	229	99	45	96
90%	109	172	300	428	515	545	487	335	161	45	45	78
Long Term												
Full Simulation Period ^b	232	347	510	631	717	783	710	566	396	258	173	191
Water Year Types^c												
Wet (32%)	232	354	522	652	777	886	812	662	516	311	196	209
Above Normal (16%)	218	365	535	646	739	828	728	547	366	165	111	127
Below Normal (13%)	234	350	526	634	694	745	658	492	296	216	163	203
Dry (24%)	226	329	495	623	688	734	675	545	358	282	173	193
Critical (15%)	258	339	465	583	633	627	577	481	325	239	197	209

Alternative 1												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	519	632	834	972	972	972	972	915	727	577	456	498
20%	394	529	719	958	972	972	972	868	681	507	376	388
30%	326	473	657	847	972	972	972	817	599	428	262	274
40%	292	426	607	800	964	972	972	769	542	381	220	236
50%	247	402	567	758	926	972	972	751	520	321	187	206
60%	213	355	534	715	875	972	922	717	486	256	166	181
70%	188	330	518	684	825	935	883	702	449	222	134	162
80%	168	294	474	646	777	870	841	663	420	198	93	136
90%	119	247	374	547	637	775	751	608	352	158	64	92
Long Term												
Full Simulation Period ^b	288	420	591	760	865	916	896	748	533	343	230	254
Water Year Types^c												
Wet (32%)	273	422	609	788	916	967	966	823	589	358	228	260
Above Normal (16%)	280	421	595	773	903	953	953	760	510	227	117	166
Below Normal (13%)	296	448	628	801	876	920	885	708	467	294	210	232
Dry (24%)	293	412	568	736	827	896	857	715	521	401	256	268
Critical (15%)	316	406	552	688	770	792	760	664	517	385	332	335

Alternative 1 minus No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	112	144	128	84	0	0	51	101	38	72	-2	62
20%	116	155	147	217	68	0	102	165	78	104	135	146
30%	93	106	104	163	174	42	142	186	135	125	84	94
40%	91	59	63	140	202	111	204	190	156	98	78	82
50%	63	52	55	136	198	164	265	205	156	91	67	71
60%	38	31	41	117	209	214	241	202	149	87	73	64
70%	27	47	64	109	215	232	257	223	162	88	58	55
80%	32	50	88	120	216	254	288	255	191	99	48	40
90%	10	75	74	119	122	230	264	273	192	113	19	13
Long Term												
Full Simulation Period ^b	56	73	82	129	148	133	186	182	137	85	58	63
Water Year Types^c												
Wet (32%)	41	68	87	136	138	81	154	160	73	47	32	50
Above Normal (16%)	62	56	60	127	164	125	225	213	144	62	6	39
Below Normal (13%)	62	97	103	167	182	175	227	216	171	78	47	29
Dry (24%)	67	83	73	113	139	162	182	170	163	119	83	75
Critical (15%)	58	67	87	105	137	165	183	183	192	146	135	126

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-5-2-2. San Luis Reservoir (CVP), End of Month Storage

No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	408	488	706	888	972	972	921	814	690	505	457	436
20%	278	373	573	741	904	972	870	703	603	403	241	242
30%	233	367	553	684	798	930	830	630	464	303	178	180
40%	201	367	544	660	762	861	768	579	387	283	142	154
50%	183	350	512	622	728	808	707	546	365	231	120	135
60%	175	324	493	599	666	758	681	515	337	170	93	116
70%	160	283	454	575	610	704	626	479	286	135	76	107
80%	136	244	386	526	561	615	552	408	229	99	45	96
90%	109	172	300	428	515	545	487	335	161	45	45	78
Long Term												
Full Simulation Period ^b	232	347	510	631	717	783	710	566	396	258	173	191
Water Year Types^c												
Wet (32%)	232	354	522	652	777	886	812	662	516	311	196	209
Above Normal (16%)	218	365	535	646	739	828	728	547	366	165	111	127
Below Normal (13%)	234	350	526	634	694	745	658	492	296	216	163	203
Dry (24%)	226	329	495	623	688	734	675	545	358	282	173	193
Critical (15%)	258	339	465	583	633	627	577	481	325	239	197	209

Alternative 3												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	601	699	886	972	972	972	972	945	842	611	519	541
20%	439	593	771	870	972	972	972	901	715	543	367	388
30%	298	447	652	784	913	972	954	842	661	412	247	247
40%	276	424	589	733	849	960	935	796	601	358	191	207
50%	252	377	552	680	805	903	881	744	529	320	169	193
60%	220	343	519	631	719	841	821	709	490	254	138	167
70%	180	306	502	608	661	766	748	590	401	206	110	149
80%	147	290	446	569	620	676	632	507	304	144	81	97
90%	97	193	341	452	545	543	489	401	237	89	45	86
Long Term												
Full Simulation Period ^b	292	422	583	691	768	823	806	704	525	332	219	245
Water Year Types^c												
Wet (32%)	308	454	627	747	871	944	943	861	695	434	277	305
Above Normal (16%)	264	399	553	639	724	831	825	717	521	247	148	182
Below Normal (13%)	330	477	653	752	799	837	790	648	429	257	165	218
Dry (24%)	286	407	565	679	728	772	748	640	461	352	231	246
Critical (15%)	265	353	487	594	634	626	596	505	356	237	198	204

Alternative 3 minus No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	193	210	180	84	0	0	51	131	152	106	62	105
20%	161	220	199	129	68	0	102	198	112	141	126	145
30%	66	80	100	101	115	42	124	212	197	109	70	67
40%	74	58	45	74	86	99	166	217	214	76	49	53
50%	69	27	39	59	77	94	174	198	164	89	49	58
60%	45	19	26	32	53	84	140	194	153	84	44	50
70%	20	23	48	33	52	63	122	111	115	71	34	42
80%	11	46	60	44	59	61	80	99	75	45	36	2
90%	-12	22	42	24	31	-2	2	66	76	44	0	8
Long Term												
Full Simulation Period ^b	60	75	74	60	51	40	95	138	129	74	46	53
Water Year Types^c												
Wet (32%)	76	101	106	95	94	57	132	199	179	123	81	96
Above Normal (16%)	46	34	18	-7	-15	3	97	170	155	82	37	55
Below Normal (13%)	96	126	127	118	106	91	132	156	133	41	3	15
Dry (24%)	60	78	71	56	40	38	73	95	102	70	58	53
Critical (15%)	7	14	22	12	1	-1	19	24	31	-3	1	-6

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-5-2-3. San Luis Reservoir (CVP), End of Month Storage

No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	408	488	706	888	972	972	921	814	690	505	457	436
20%	278	373	573	741	904	972	870	703	603	403	241	242
30%	233	367	553	684	798	930	830	630	464	303	178	180
40%	201	367	544	660	762	861	768	579	387	283	142	154
50%	183	350	512	622	728	808	707	546	365	231	120	135
60%	175	324	493	599	666	758	681	515	337	170	93	116
70%	160	283	454	575	610	704	626	479	286	135	76	107
80%	136	244	386	526	561	615	552	408	229	99	45	96
90%	109	172	300	428	515	545	487	335	161	45	45	78
Long Term												
Full Simulation Period ^b	232	347	510	631	717	783	710	566	396	258	173	191
Water Year Types ^c												
Wet (32%)	232	354	522	652	777	886	812	662	516	311	196	209
Above Normal (16%)	218	365	535	646	739	828	728	547	366	165	111	127
Below Normal (13%)	234	350	526	634	694	745	658	492	296	216	163	203
Dry (24%)	226	329	495	623	688	734	675	545	358	282	173	193
Critical (15%)	258	339	465	583	633	627	577	481	325	239	197	209

Alternative 5												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	367	491	703	875	972	972	921	808	686	505	408	410
20%	271	367	570	721	859	972	861	696	552	398	233	232
30%	218	367	550	689	794	925	827	624	449	287	179	184
40%	191	359	539	644	764	851	751	569	383	245	127	157
50%	183	344	512	621	715	809	712	532	351	199	107	131
60%	170	307	489	592	664	758	651	466	286	154	92	113
70%	157	275	423	550	603	701	628	430	243	122	82	99
80%	135	224	375	474	553	617	526	359	171	79	45	90
90%	107	165	293	422	503	526	449	288	83	45	45	74
Long Term												
Full Simulation Period ^b	223	337	500	624	712	778	694	535	371	241	165	183
Water Year Types ^c												
Wet (32%)	228	356	525	657	781	891	819	670	525	321	205	213
Above Normal (16%)	213	346	517	634	728	818	720	541	366	168	112	126
Below Normal (13%)	226	342	516	625	695	747	655	478	289	217	159	203
Dry (24%)	215	314	481	609	675	721	634	470	293	235	150	176
Critical (15%)	236	318	442	566	620	613	531	398	250	179	164	175

Alternative 5 minus No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-41	3	-3	-13	0	0	0	-6	-3	0	-49	-25
20%	-7	-7	-2	-20	-45	0	-9	-8	-51	-4	-8	-10
30%	-15	0	-3	5	-5	-4	-3	-7	-15	-16	1	4
40%	-10	-8	-4	-15	1	-10	-17	-10	-4	-38	-15	4
50%	0	-5	0	-1	-13	1	4	-14	-14	-31	-13	-4
60%	-5	-17	-4	-7	-2	1	-30	-49	-51	-16	-2	-4
70%	-3	-9	-30	-25	-6	-3	3	-49	-43	-13	6	-8
80%	-1	-20	-11	-51	-8	1	-26	-50	-58	-20	0	-6
90%	-2	-6	-6	-6	-12	-19	-38	-46	-77	0	0	-4
Long Term												
Full Simulation Period ^b	-9	-10	-10	-7	-6	-5	-16	-31	-25	-17	-8	-8
Water Year Types ^c												
Wet (32%)	-4	2	3	5	4	5	7	8	9	10	9	4
Above Normal (16%)	-5	-19	-19	-12	-11	-10	-8	-6	0	3	1	-1
Below Normal (13%)	-8	-8	-10	-9	1	2	-3	-14	-7	1	-4	-1
Dry (24%)	-11	-15	-13	-14	-13	-13	-41	-75	-65	-46	-23	-17
Critical (15%)	-22	-21	-24	-17	-13	-14	-46	-82	-75	-61	-33	-34

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-5-2-4. San Luis Reservoir (CVP), End of Month Storage

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	519	632	834	972	972	972	972	915	727	577	456	498
20%	394	529	719	958	972	972	972	868	681	507	376	388
30%	326	473	657	847	972	972	972	817	599	428	262	274
40%	292	426	607	800	964	972	972	769	542	381	220	236
50%	247	402	567	758	926	972	972	751	520	321	187	206
60%	213	355	534	715	875	972	922	717	486	256	166	181
70%	188	330	518	684	825	935	883	702	449	222	134	162
80%	168	294	474	646	777	870	841	663	420	198	93	136
90%	119	247	374	547	637	775	751	608	352	158	64	92
Long Term												
Full Simulation Period ^b	288	420	591	760	865	916	896	748	533	343	230	254
Water Year Types ^c												
Wet (32%)	273	422	609	788	916	967	966	823	589	358	228	260
Above Normal (16%)	280	421	595	773	903	953	953	760	510	227	117	166
Below Normal (13%)	296	448	628	801	876	920	885	708	467	294	210	232
Dry (24%)	293	412	568	736	827	896	857	715	521	401	256	268
Critical (15%)	316	406	552	688	770	792	760	664	517	385	332	335

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance ^a												
10%	408	488	706	888	972	972	921	814	690	505	457	436
20%	278	373	573	741	904	972	870	703	603	403	241	242
30%	233	367	553	684	798	930	830	630	464	303	178	180
40%	201	367	544	660	762	861	768	579	387	283	142	154
50%	183	350	512	622	728	808	707	546	365	231	120	135
60%	175	324	493	599	666	758	681	515	337	170	93	116
70%	160	283	454	575	610	704	626	479	286	135	76	107
80%	136	244	386	526	561	615	552	408	229	99	45	96
90%	109	172	300	428	515	545	487	335	161	45	45	78
Long Term												
Full Simulation Period ^b	232	347	510	631	717	783	710	566	396	258	173	191
Water Year Types ^c												
Wet (32%)	232	354	522	652	777	886	812	662	516	311	196	209
Above Normal (16%)	218	365	535	646	739	828	728	547	366	165	111	127
Below Normal (13%)	234	350	526	634	694	745	658	492	296	216	163	203
Dry (24%)	226	329	495	623	688	734	675	545	358	282	173	193
Critical (15%)	258	339	465	583	633	627	577	481	325	239	197	209

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative minus Second Basis of Comparison												
Probability of Exceedance ^a												
10%	-112	-144	-128	-84	0	0	-51	-101	-38	-72	2	-62
20%	-116	-155	-147	-217	-68	0	-102	-165	-78	-104	-135	-146
30%	-93	-106	-104	-163	-174	-42	-142	-186	-135	-125	-84	-94
40%	-91	-59	-63	-140	-202	-111	-204	-190	-156	-98	-78	-82
50%	-63	-52	-55	-136	-198	-164	-265	-205	-156	-91	-67	-71
60%	-38	-31	-41	-117	-209	-214	-241	-202	-149	-87	-73	-64
70%	-27	-47	-64	-109	-215	-232	-257	-223	-162	-88	-58	-55
80%	-32	-50	-88	-120	-216	-254	-288	-255	-191	-99	-48	-40
90%	-10	-75	-74	-119	-122	-230	-264	-273	-192	-113	-19	-13
Long Term												
Full Simulation Period ^b	-56	-73	-82	-129	-148	-133	-186	-182	-137	-85	-58	-63
Water Year Types ^c												
Wet (32%)	-41	-68	-87	-136	-138	-81	-154	-160	-73	-47	-32	-50
Above Normal (16%)	-62	-56	-60	-127	-164	-125	-225	-213	-144	-62	-6	-39
Below Normal (13%)	-62	-97	-103	-167	-182	-175	-227	-216	-171	-78	-47	-29
Dry (24%)	-67	-83	-73	-113	-139	-162	-182	-170	-163	-119	-83	-75
Critical (15%)	-58	-67	-87	-105	-137	-165	-183	-183	-192	-146	-135	-126

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-5-2-5. San Luis Reservoir (CVP), End of Month Storage

Second Basis of Comparison												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	519	632	834	972	972	972	972	915	727	577	456	498
20%	394	529	719	958	972	972	972	868	681	507	376	388
30%	326	473	657	847	972	972	972	817	599	428	262	274
40%	292	426	607	800	964	972	972	769	542	381	220	236
50%	247	402	567	758	926	972	972	751	520	321	187	206
60%	213	355	534	715	875	972	922	717	486	256	166	181
70%	188	330	518	684	825	935	883	702	449	222	134	162
80%	168	294	474	646	777	870	841	663	420	198	93	136
90%	119	247	374	547	637	775	751	608	352	158	64	92
Long Term												
Full Simulation Period ^b	288	420	591	760	865	916	896	748	533	343	230	254
Water Year Types^c												
Wet (32%)	273	422	609	788	916	967	966	823	589	358	228	260
Above Normal (16%)	280	421	595	773	903	953	953	760	510	227	117	166
Below Normal (13%)	296	448	628	801	876	920	885	708	467	294	210	232
Dry (24%)	293	412	568	736	827	896	857	715	521	401	256	268
Critical (15%)	316	406	552	688	770	792	760	664	517	385	332	335

Alternative 3												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	601	699	886	972	972	972	972	945	842	611	519	541
20%	439	593	771	870	972	972	972	901	715	543	367	388
30%	298	447	652	784	913	972	954	842	661	412	247	247
40%	276	424	589	733	849	960	935	796	601	358	191	207
50%	252	377	552	680	805	903	881	744	529	320	169	193
60%	220	343	519	631	719	841	821	709	490	254	138	167
70%	180	306	502	608	661	766	748	590	401	206	110	149
80%	147	290	446	569	620	676	632	507	304	144	81	97
90%	97	193	341	452	545	543	489	401	237	89	45	86
Long Term												
Full Simulation Period ^b	292	422	583	691	768	823	806	704	525	332	219	245
Water Year Types^c												
Wet (32%)	308	454	627	747	871	944	943	861	695	434	277	305
Above Normal (16%)	264	399	553	639	724	831	825	717	521	247	148	182
Below Normal (13%)	330	477	653	752	799	837	790	648	429	257	165	218
Dry (24%)	286	407	565	679	728	772	748	640	461	352	231	246
Critical (15%)	265	353	487	594	634	626	596	505	356	237	198	204

Alternative 3 minus Second Basis of Comparison												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	81	67	52	0	0	0	0	30	114	34	63	43
20%	45	65	52	-88	0	0	0	33	34	36	-9	0
30%	-28	-26	-5	-63	-59	0	-18	26	62	-16	-15	-27
40%	-16	-1	-18	-66	-115	-12	-37	27	58	-23	-29	-29
50%	5	-24	-15	-78	-121	-69	-91	-7	9	-1	-19	-13
60%	8	-13	-15	-84	-156	-131	-101	-9	4	-3	-29	-14
70%	-7	-24	-16	-76	-163	-169	-135	-112	-48	-17	-25	-13
80%	-21	-4	-28	-77	-157	-193	-208	-156	-116	-54	-12	-38
90%	-22	-53	-32	-95	-92	-231	-262	-207	-116	-70	-19	-6
Long Term												
Full Simulation Period ^b	4	2	-8	-69	-97	-93	-91	-44	-8	-11	-11	-9
Water Year Types^c												
Wet (32%)	35	33	18	-42	-45	-24	-22	39	106	76	48	46
Above Normal (16%)	-16	-22	-42	-134	-179	-122	-128	-43	11	21	31	16
Below Normal (13%)	33	29	25	-49	-77	-83	-95	-60	-38	-37	-44	-14
Dry (24%)	-7	-5	-2	-57	-99	-124	-109	-74	-61	-49	-25	-22
Critical (15%)	-52	-53	-65	-94	-135	-166	-164	-159	-161	-148	-134	-131

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-5-2-6. San Luis Reservoir (CVP), End of Month Storage

Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	519	632	834	972	972	972	972	915	727	577	456	498
20%	394	529	719	958	972	972	972	868	681	507	376	388
30%	326	473	657	847	972	972	972	817	599	428	262	274
40%	292	426	607	800	964	972	972	769	542	381	220	236
50%	247	402	567	758	926	972	972	751	520	321	187	206
60%	213	355	534	715	875	972	922	717	486	256	166	181
70%	188	330	518	684	825	935	883	702	449	222	134	162
80%	168	294	474	646	777	870	841	663	420	198	93	136
90%	119	247	374	547	637	775	751	608	352	158	64	92
Long Term												
Full Simulation Period ^b	288	420	591	760	865	916	896	748	533	343	230	254
Water Year Types^c												
Wet (32%)	273	422	609	788	916	967	966	823	589	358	228	260
Above Normal (16%)	280	421	595	773	903	953	953	760	510	227	117	166
Below Normal (13%)	296	448	628	801	876	920	885	708	467	294	210	232
Dry (24%)	293	412	568	736	827	896	857	715	521	401	256	268
Critical (15%)	316	406	552	688	770	792	760	664	517	385	332	335

Alternative 5

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	367	491	703	875	972	972	921	808	686	505	408	410
20%	271	367	570	721	859	972	861	696	552	398	233	232
30%	218	367	550	689	794	925	827	624	449	287	179	184
40%	191	359	539	644	764	851	751	569	383	245	127	157
50%	183	344	512	621	715	809	712	532	351	199	107	131
60%	170	307	489	592	664	758	651	466	286	154	92	113
70%	157	275	423	550	603	701	628	430	243	122	82	99
80%	135	224	375	474	553	617	526	359	171	79	45	90
90%	107	165	293	422	503	526	449	288	83	45	45	74
Long Term												
Full Simulation Period ^b	223	337	500	624	712	778	694	535	371	241	165	183
Water Year Types^c												
Wet (32%)	228	356	525	657	781	891	819	670	525	321	205	213
Above Normal (16%)	213	346	517	634	728	818	720	541	366	168	112	126
Below Normal (13%)	226	342	516	625	695	747	655	478	289	217	159	203
Dry (24%)	215	314	481	609	675	721	634	470	293	235	150	176
Critical (15%)	236	318	442	566	620	613	531	398	250	179	164	175

Alternative 5 minus Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-153	-141	-131	-97	0	0	-51	-107	-41	-71	-48	-88
20%	-122	-162	-149	-237	-113	0	-111	-173	-129	-109	-143	-156
30%	-108	-106	-107	-158	-178	-47	-145	-193	-150	-141	-83	-90
40%	-101	-67	-68	-155	-200	-121	-221	-200	-160	-136	-93	-79
50%	-63	-57	-55	-137	-211	-163	-260	-219	-169	-122	-80	-75
60%	-42	-48	-45	-123	-212	-214	-271	-252	-200	-103	-75	-68
70%	-30	-56	-95	-134	-222	-234	-254	-272	-205	-100	-53	-63
80%	-33	-70	-99	-171	-224	-253	-314	-305	-249	-119	-48	-46
90%	-12	-81	-80	-125	-134	-249	-302	-319	-269	-113	-19	-17
Long Term												
Full Simulation Period ^b	-65	-83	-91	-136	-154	-138	-202	-212	-162	-102	-66	-71
Water Year Types^c												
Wet (32%)	-44	-66	-84	-132	-134	-76	-147	-152	-64	-38	-24	-47
Above Normal (16%)	-67	-74	-79	-139	-175	-135	-233	-219	-144	-59	-5	-40
Below Normal (13%)	-70	-105	-112	-176	-181	-173	-230	-230	-178	-77	-51	-29
Dry (24%)	-79	-98	-86	-127	-152	-175	-223	-244	-228	-165	-106	-92
Critical (15%)	-80	-88	-110	-122	-150	-179	-229	-265	-267	-206	-168	-160


a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-5-3-1. San Luis Reservoir (SWP), End of May Storage

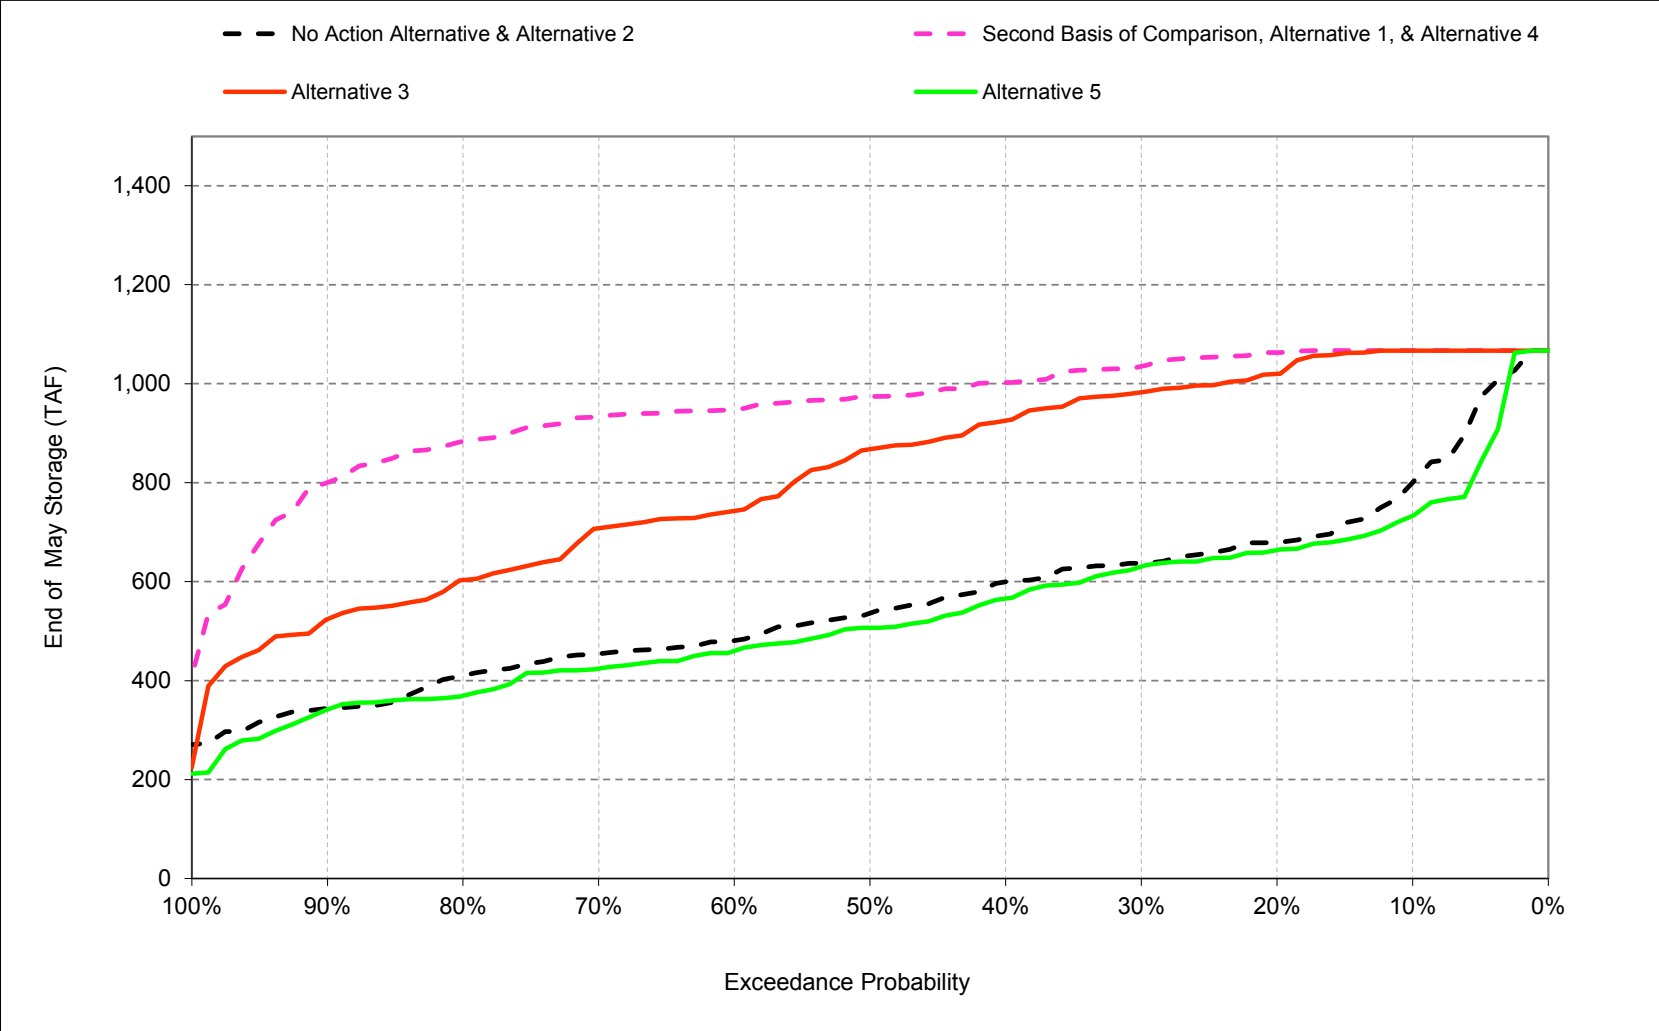


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-5-3-2. San Luis Reservoir (SWP), End of August Storage

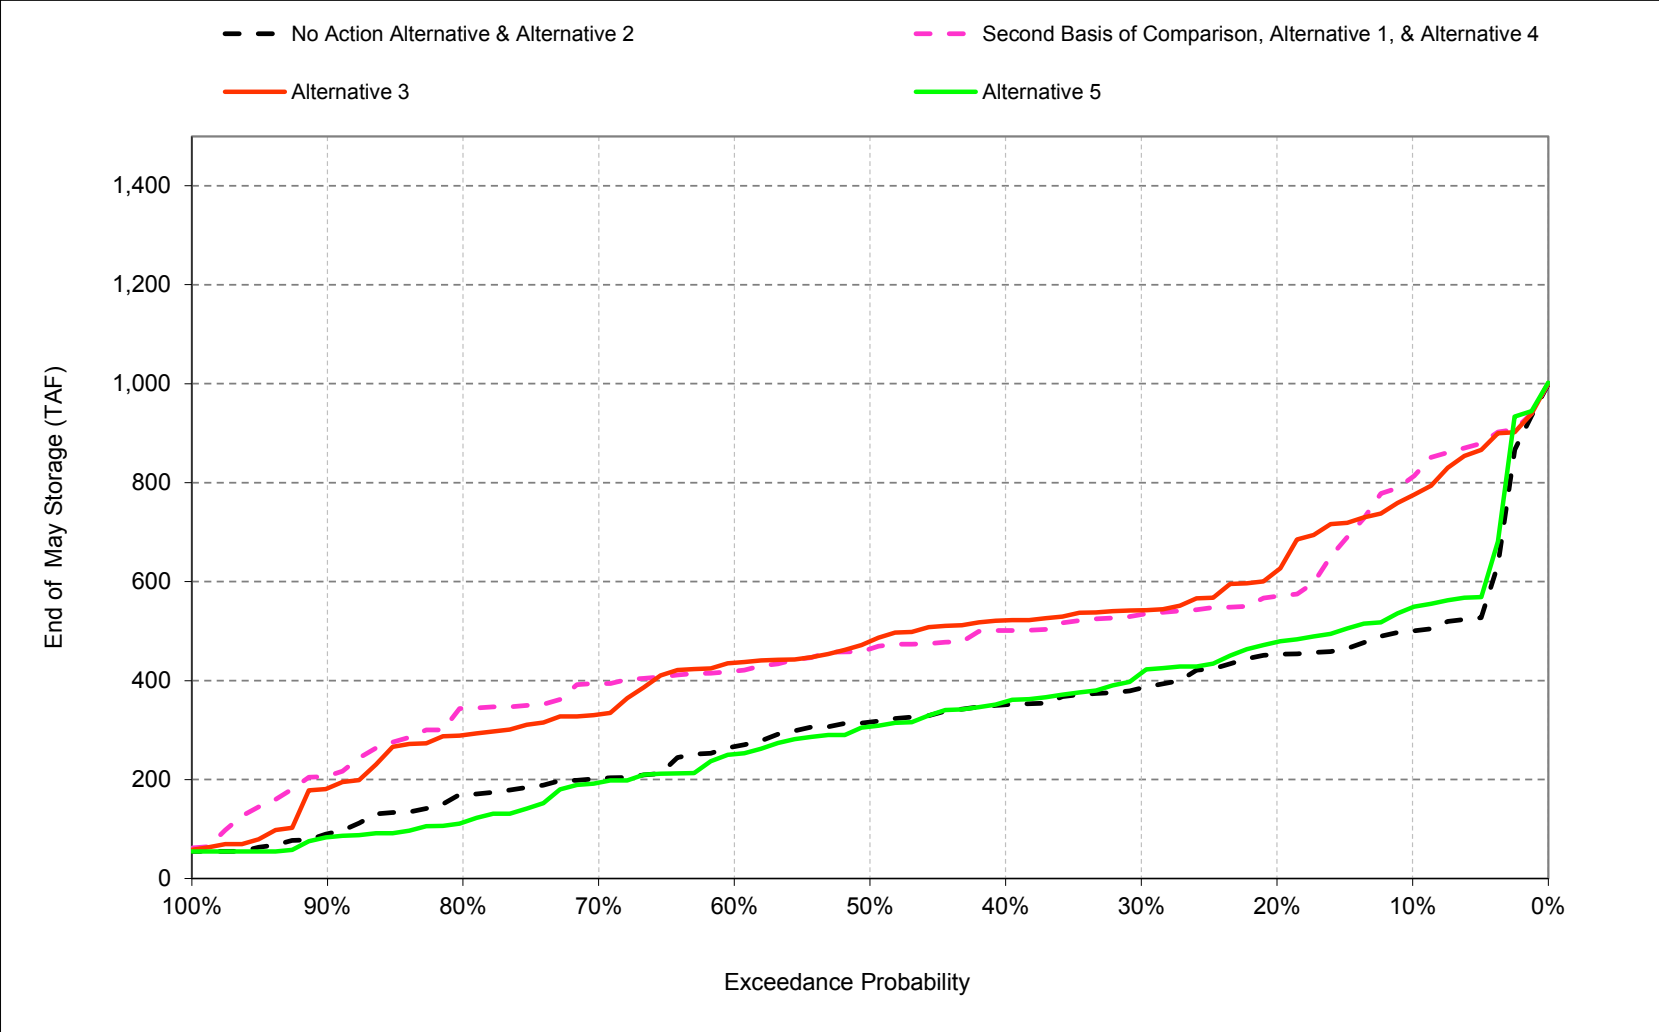

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-5-3-3. San Luis Reservoir (SWP), End of September Storage

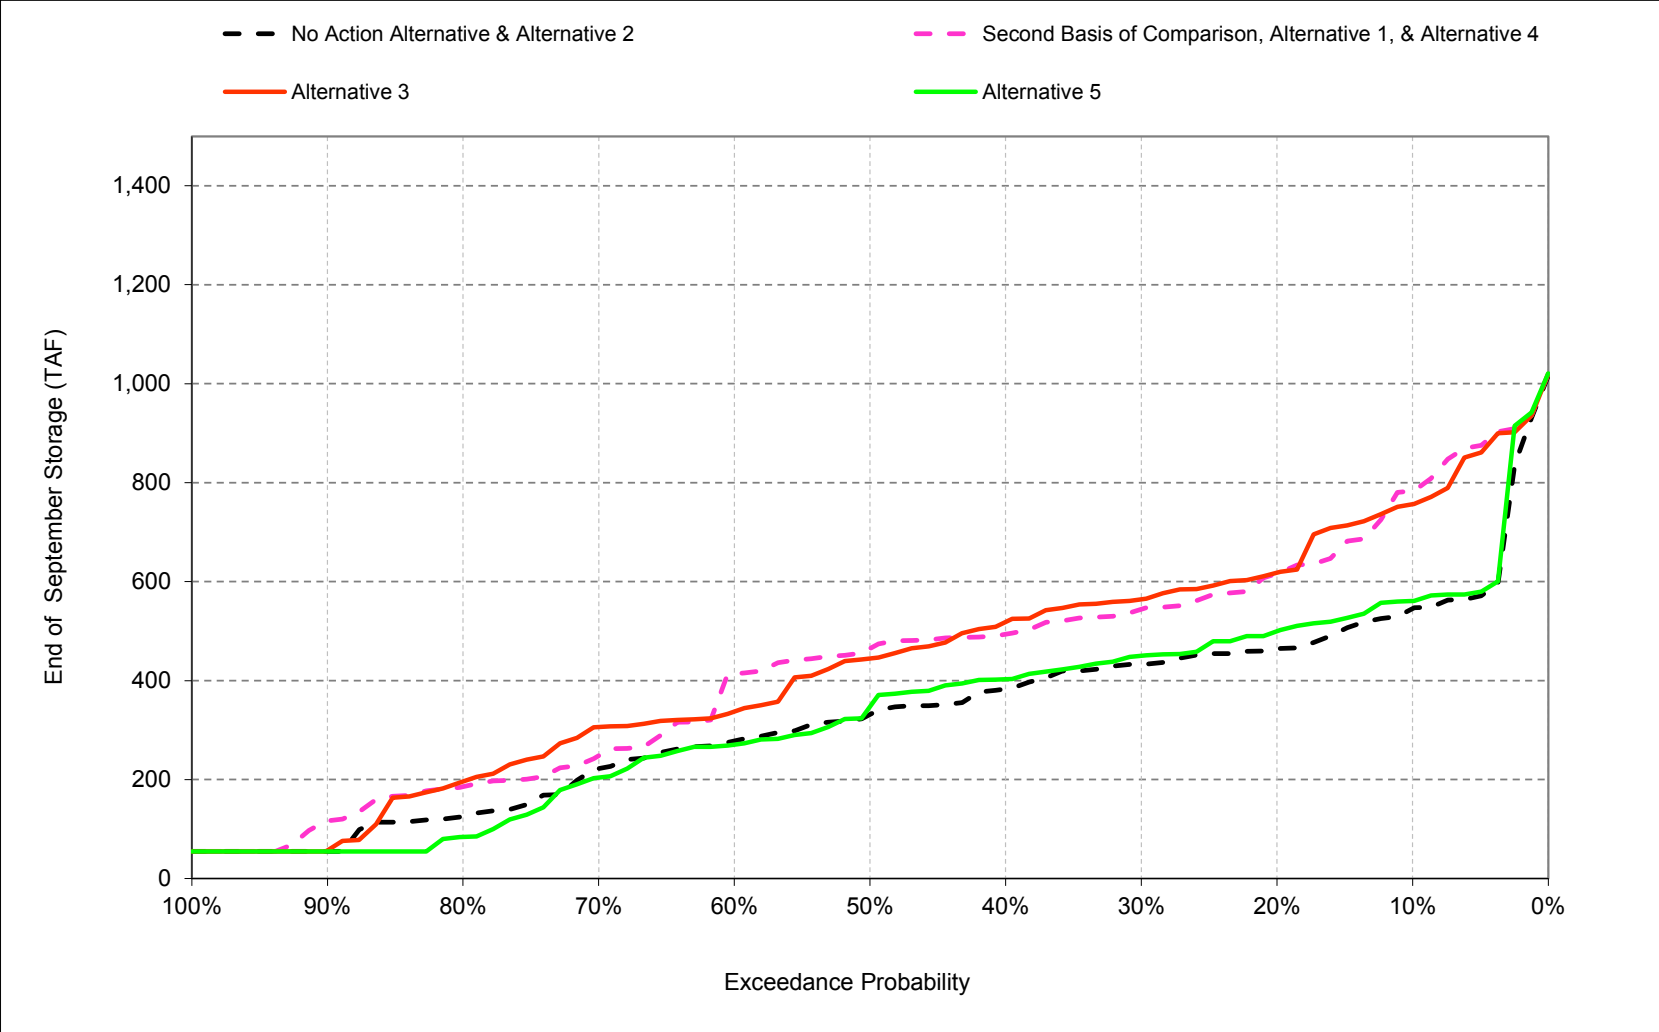

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-5-3-1. San Luis Reservoir (SWP), End of Month Storage

No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	532	574	700	925	1,067	1,067	964	800	613	595	501	545
20%	414	443	605	795	878	1,025	916	679	528	495	453	464
30%	339	357	524	656	801	942	821	637	455	450	385	433
40%	304	327	449	581	719	894	777	600	405	402	351	383
50%	254	242	362	495	657	804	749	536	361	351	316	332
60%	205	164	243	431	609	755	667	481	321	317	266	278
70%	166	88	200	369	511	664	590	454	283	298	202	222
80%	75	55	153	303	435	556	530	410	250	229	170	126
90%	55	55	59	243	380	502	458	344	212	173	91	55
Long Term												
Full Simulation Period ^b	278	281	381	540	674	792	721	562	397	384	318	330
Water Year Types^c												
Wet (32%)	323	327	410	584	749	901	787	589	430	430	432	470
Above Normal (16%)	272	284	421	577	702	832	716	501	300	301	322	387
Below Normal (13%)	291	274	381	507	620	728	653	475	259	284	263	264
Dry (24%)	250	261	373	527	650	760	738	623	482	481	303	277
Critical (15%)	220	218	286	457	571	625	615	548	415	305	145	114

Alternative 1												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	837	847	998	1,067	1,067	1,067	1,067	1,067	1,001	925	811	783
20%	623	695	894	1,067	1,067	1,067	1,067	1,063	911	769	571	617
30%	552	660	803	1,067	1,067	1,067	1,067	1,035	886	713	534	544
40%	482	579	680	977	1,067	1,067	1,067	1,002	849	681	501	494
50%	452	474	622	882	1,067	1,067	1,067	974	826	651	464	465
60%	352	406	487	800	1,066	1,067	1,067	948	779	628	419	414
70%	212	268	439	664	953	1,067	1,027	934	739	604	394	248
80%	133	166	287	585	850	1,029	994	883	702	539	344	186
90%	55	77	130	486	740	941	921	800	643	474	207	117
Long Term												
Full Simulation Period ^b	422	475	589	825	966	1,025	1,014	949	805	657	475	433
Water Year Types^c												
Wet (32%)	517	595	756	960	1,049	1,066	1,066	1,030	898	809	661	665
Above Normal (16%)	377	462	618	898	1,010	1,049	1,043	957	753	635	495	465
Below Normal (13%)	558	616	705	941	1,032	1,060	1,023	920	784	671	426	359
Dry (24%)	324	352	430	692	901	1,029	1,012	951	820	606	404	329
Critical (15%)	306	304	358	569	786	872	863	787	651	422	213	137

Alternative 1 minus No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	305	273	297	142	0	0	103	267	387	330	310	238
20%	209	251	289	272	189	42	151	384	382	274	118	153
30%	213	303	279	411	266	125	246	398	431	263	149	111
40%	178	252	231	395	348	173	290	402	444	279	150	110
50%	199	232	260	388	410	263	318	438	466	300	148	133
60%	147	242	245	369	457	312	400	467	458	310	153	136
70%	46	180	239	295	442	403	437	479	456	306	192	26
80%	58	111	134	283	415	474	464	473	452	310	174	60
90%	0	22	71	243	360	439	464	457	431	301	117	62
Long Term												
Full Simulation Period ^b	144	194	209	285	292	233	293	387	408	273	156	103
Water Year Types^c												
Wet (32%)	194	268	346	376	300	164	279	441	468	379	229	195
Above Normal (16%)	106	178	196	321	308	216	327	456	454	334	173	78
Below Normal (13%)	267	342	325	434	412	332	369	444	525	387	162	95
Dry (24%)	74	91	57	164	250	269	274	328	338	125	101	52
Critical (15%)	85	86	71	112	216	247	248	240	237	118	67	23

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-5-3-2. San Luis Reservoir (SWP), End of Month Storage

No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	532	574	700	925	1,067	1,067	964	800	613	595	501	545
20%	414	443	605	795	878	1,025	916	679	528	495	453	464
30%	339	357	524	656	801	942	821	637	455	450	385	433
40%	304	327	449	581	719	894	777	600	405	402	351	383
50%	254	242	362	495	657	804	749	536	361	351	316	332
60%	205	164	243	431	609	755	667	481	321	317	266	278
70%	166	88	200	369	511	664	590	454	283	298	202	222
80%	75	55	153	303	435	556	530	410	250	229	170	126
90%	55	55	59	243	380	502	458	344	212	173	91	55
Long Term												
Full Simulation Period ^b	278	281	381	540	674	792	721	562	397	384	318	330
Water Year Types^c												
Wet (32%)	323	327	410	584	749	901	787	589	430	430	432	470
Above Normal (16%)	272	284	421	577	702	832	716	501	300	301	322	387
Below Normal (13%)	291	274	381	507	620	728	653	475	259	284	263	264
Dry (24%)	250	261	373	527	650	760	738	623	482	481	303	277
Critical (15%)	220	218	286	457	571	625	615	548	415	305	145	114

Alternative 3												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	791	864	912	1,049	1,067	1,067	1,067	1,067	951	856	774	756
20%	663	730	806	968	1,067	1,067	1,067	1,020	838	752	622	618
30%	552	618	701	854	1,002	1,067	1,067	983	783	706	542	564
40%	457	512	628	801	922	1,055	1,032	925	712	642	522	519
50%	375	451	582	720	835	937	973	867	659	604	479	445
60%	302	411	477	619	774	899	876	743	594	549	436	337
70%	226	286	399	540	671	820	802	708	545	489	331	306
80%	119	181	239	408	598	695	726	603	481	427	290	196
90%	55	57	143	341	415	534	570	524	406	320	182	57
Long Term												
Full Simulation Period ^b	410	467	547	689	805	885	890	813	664	598	471	434
Water Year Types^c												
Wet (32%)	502	578	649	809	939	1,014	1,032	989	844	794	684	674
Above Normal (16%)	355	444	556	703	847	925	938	857	633	582	526	521
Below Normal (13%)	504	566	652	737	823	899	860	690	470	480	420	343
Dry (24%)	348	396	487	624	727	836	845	773	667	574	359	289
Critical (15%)	283	279	317	482	581	630	631	563	482	336	182	147

Alternative 3 minus No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	259	290	212	124	0	0	103	267	338	262	274	211
20%	248	287	201	174	189	42	151	341	310	258	169	154
30%	213	261	177	198	202	125	246	345	328	255	157	131
40%	153	186	178	220	203	161	255	325	307	240	171	135
50%	121	209	220	226	177	133	224	331	299	253	163	113
60%	97	247	235	188	165	144	208	262	273	231	169	60
70%	59	197	199	171	160	156	212	254	262	191	129	84
80%	44	126	85	106	164	139	196	193	231	198	120	70
90%	0	2	84	98	35	31	113	181	194	147	92	2
Long Term												
Full Simulation Period ^b	132	186	166	149	131	93	169	251	268	213	153	105
Water Year Types^c												
Wet (32%)	179	251	239	225	190	112	245	400	414	364	253	204
Above Normal (16%)	84	160	135	126	145	93	222	356	334	281	204	135
Below Normal (13%)	213	293	271	230	203	171	207	214	211	196	157	79
Dry (24%)	98	136	114	96	77	76	107	151	185	93	56	12
Critical (15%)	63	62	31	25	11	5	15	16	67	31	36	33

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-5-3-3. San Luis Reservoir (SWP), End of Month Storage

No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	532	574	700	925	1,067	1,067	964	800	613	595	501	545
20%	414	443	605	795	878	1,025	916	679	528	495	453	464
30%	339	357	524	656	801	942	821	637	455	450	385	433
40%	304	327	449	581	719	894	777	600	405	402	351	383
50%	254	242	362	495	657	804	749	536	361	351	316	332
60%	205	164	243	431	609	755	667	481	321	317	266	278
70%	166	88	200	369	511	664	590	454	283	298	202	222
80%	75	55	153	303	435	556	530	410	250	229	170	126
90%	55	55	59	243	380	502	458	344	212	173	91	55
Long Term												
Full Simulation Period ^b	278	281	381	540	674	792	721	562	397	384	318	330
Water Year Types^c												
Wet (32%)	323	327	410	584	749	901	787	589	430	430	432	470
Above Normal (16%)	272	284	421	577	702	832	716	501	300	301	322	387
Below Normal (13%)	291	274	381	507	620	728	653	475	259	284	263	264
Dry (24%)	250	261	373	527	650	760	738	623	482	481	303	277
Critical (15%)	220	218	286	457	571	625	615	548	415	305	145	114

Alternative 5												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	512	520	706	913	1,065	1,067	935	733	620	580	548	561
20%	431	476	577	750	867	1,013	899	664	489	492	478	500
30%	373	369	500	647	806	943	827	630	422	448	415	450
40%	334	318	463	573	724	874	764	566	381	379	358	403
50%	290	235	363	496	666	803	734	507	332	325	307	347
60%	201	194	285	432	618	750	639	460	289	296	251	271
70%	144	116	234	385	525	672	583	424	273	270	194	204
80%	66	66	176	344	446	583	552	369	233	217	113	84
90%	55	55	74	249	378	477	442	342	178	181	84	55
Long Term												
Full Simulation Period ^b	285	283	387	543	678	797	710	533	374	370	318	333
Water Year Types^c												
Wet (32%)	347	350	433	594	758	912	805	609	459	466	475	513
Above Normal (16%)	275	276	416	579	712	842	727	505	306	309	329	394
Below Normal (13%)	315	286	407	533	641	749	649	451	235	258	255	260
Dry (24%)	249	258	375	530	652	760	690	532	398	420	262	243
Critical (15%)	193	187	256	428	546	603	572	476	350	249	120	95

Alternative 5 minus No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-21	-54	5	-12	-2	0	-29	-68	6	-15	48	15
20%	17	32	-28	-45	-11	-12	-16	-15	-39	-3	25	36
30%	34	12	-24	-9	6	1	6	-7	-33	-2	30	17
40%	30	-9	14	-9	5	-20	-12	-34	-24	-23	7	19
50%	36	-7	2	2	8	-2	-15	-29	-29	-26	-9	16
60%	-4	30	43	1	9	-5	-29	-21	-32	-21	-15	-7
70%	-23	27	34	16	14	8	-7	-30	-10	-27	-8	-18
80%	-9	10	23	42	11	27	21	-41	-18	-12	-57	-42
90%	0	0	15	6	-1	-26	-15	-2	-34	8	-7	0
Long Term												
Full Simulation Period ^b	7	2	6	3	4	5	-11	-29	-23	-14	0	3
Water Year Types^c												
Wet (32%)	24	23	24	10	9	11	18	20	29	36	43	43
Above Normal (16%)	3	-9	-6	2	10	9	12	4	7	7	7	8
Below Normal (13%)	24	12	26	26	20	21	-4	-24	-24	-25	-8	-3
Dry (24%)	-1	-3	2	2	1	0	-48	-91	-83	-61	-41	-34
Critical (15%)	-28	-30	-30	-29	-24	-22	-44	-71	-65	-55	-26	-19

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-5-3-4. San Luis Reservoir (SWP), End of Month Storage

Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	837	847	998	1,067	1,067	1,067	1,067	1,067	1,001	925	811	783
20%	623	695	894	1,067	1,067	1,067	1,067	1,063	911	769	571	617
30%	552	660	803	1,067	1,067	1,067	1,067	1,035	886	713	534	544
40%	482	579	680	977	1,067	1,067	1,067	1,002	849	681	501	494
50%	452	474	622	882	1,067	1,067	1,067	974	826	651	464	465
60%	352	406	487	800	1,066	1,067	1,067	948	779	628	419	414
70%	212	268	439	664	953	1,067	1,027	934	739	604	394	248
80%	133	166	287	585	850	1,029	994	883	702	539	344	186
90%	55	77	130	486	740	941	921	800	643	474	207	117
Long Term												
Full Simulation Period ^b	422	475	589	825	966	1,025	1,014	949	805	657	475	433
Water Year Types^c												
Wet (32%)	517	595	756	960	1,049	1,066	1,066	1,030	898	809	661	665
Above Normal (16%)	377	462	618	898	1,010	1,049	1,043	957	753	635	495	465
Below Normal (13%)	558	616	705	941	1,032	1,060	1,023	920	784	671	426	359
Dry (24%)	324	352	430	692	901	1,029	1,012	951	820	606	404	329
Critical (15%)	306	304	358	569	786	872	863	787	651	422	213	137

No Action Alternative

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	532	574	700	925	1,067	1,067	964	800	613	595	501	545
20%	414	443	605	795	878	1,025	916	679	528	495	453	464
30%	339	357	524	656	801	942	821	637	455	450	385	433
40%	304	327	449	581	719	894	777	600	405	402	351	383
50%	254	242	362	495	657	804	749	536	361	351	316	332
60%	205	164	243	431	609	755	667	481	321	317	266	278
70%	166	88	200	369	511	664	590	454	283	298	202	222
80%	75	55	153	303	435	556	530	410	250	229	170	126
90%	55	55	59	243	380	502	458	344	212	173	91	55
Long Term												
Full Simulation Period ^b	278	281	381	540	674	792	721	562	397	384	318	330
Water Year Types^c												
Wet (32%)	323	327	410	584	749	901	787	589	430	430	432	470
Above Normal (16%)	272	284	421	577	702	832	716	501	300	301	322	387
Below Normal (13%)	291	274	381	507	620	728	653	475	259	284	263	264
Dry (24%)	250	261	373	527	650	760	738	623	482	481	303	277
Critical (15%)	220	218	286	457	571	625	615	548	415	305	145	114

No Action Alternative minus Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-305	-273	-297	-142	0	0	-103	-267	-387	-330	-310	-238
20%	-209	-251	-289	-272	-189	-42	-151	-384	-382	-274	-118	-153
30%	-213	-303	-279	-411	-266	-125	-246	-398	-431	-263	-149	-111
40%	-178	-252	-231	-395	-348	-173	-290	-402	-444	-279	-150	-110
50%	-199	-232	-260	-388	-410	-263	-318	-438	-466	-300	-148	-133
60%	-147	-242	-245	-369	-457	-312	-400	-467	-458	-310	-153	-136
70%	-46	-180	-239	-295	-442	-403	-437	-479	-456	-306	-192	-26
80%	-58	-111	-134	-283	-415	-474	-464	-473	-452	-310	-174	-60
90%	0	-22	-71	-243	-360	-439	-464	-457	-431	-301	-117	-62
Long Term												
Full Simulation Period ^b	-144	-194	-209	-285	-292	-233	-293	-387	-408	-273	-156	-103
Water Year Types^c												
Wet (32%)	-194	-268	-346	-376	-300	-164	-279	-441	-468	-379	-229	-195
Above Normal (16%)	-106	-178	-196	-321	-308	-216	-327	-456	-454	-334	-173	-78
Below Normal (13%)	-267	-342	-325	-434	-412	-332	-369	-444	-525	-387	-162	-95
Dry (24%)	-74	-91	-57	-164	-250	-269	-274	-328	-338	-125	-101	-52
Critical (15%)	-85	-86	-71	-112	-216	-247	-248	-240	-237	-118	-67	-23

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-5-3-5. San Luis Reservoir (SWP), End of Month Storage

Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	837	847	998	1,067	1,067	1,067	1,067	1,067	1,001	925	811	783
20%	623	695	894	1,067	1,067	1,067	1,067	1,063	911	769	571	617
30%	552	660	803	1,067	1,067	1,067	1,067	1,035	886	713	534	544
40%	482	579	680	977	1,067	1,067	1,067	1,002	849	681	501	494
50%	452	474	622	882	1,067	1,067	1,067	974	826	651	464	465
60%	352	406	487	800	1,066	1,067	1,067	948	779	628	419	414
70%	212	268	439	664	953	1,067	1,027	934	739	604	394	248
80%	133	166	287	585	850	1,029	994	883	702	539	344	186
90%	55	77	130	486	740	941	921	800	643	474	207	117
Long Term												
Full Simulation Period ^b	422	475	589	825	966	1,025	1,014	949	805	657	475	433
Water Year Types ^c												
Wet (32%)	517	595	756	960	1,049	1,066	1,066	1,030	898	809	661	665
Above Normal (16%)	377	462	618	898	1,010	1,049	1,043	957	753	635	495	465
Below Normal (13%)	558	616	705	941	1,032	1,060	1,023	920	784	671	426	359
Dry (24%)	324	352	430	692	901	1,029	1,012	951	820	606	404	329
Critical (15%)	306	304	358	569	786	872	863	787	651	422	213	137

Alternative 3

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	791	864	912	1,049	1,067	1,067	1,067	1,067	951	856	774	756
20%	663	730	806	968	1,067	1,067	1,067	1,020	838	752	622	618
30%	552	618	701	854	1,002	1,067	1,067	983	783	706	542	564
40%	457	512	628	801	922	1,055	1,032	925	712	642	522	519
50%	375	451	582	720	835	937	973	867	659	604	479	445
60%	302	411	477	619	774	899	876	743	594	549	436	337
70%	226	286	399	540	671	820	802	708	545	489	331	306
80%	119	181	239	408	598	695	726	603	481	427	290	196
90%	55	57	143	341	415	534	570	524	406	320	182	57
Long Term												
Full Simulation Period ^b	410	467	547	689	805	885	890	813	664	598	471	434
Water Year Types ^c												
Wet (32%)	502	578	649	809	939	1,014	1,032	989	844	794	684	674
Above Normal (16%)	355	444	556	703	847	925	938	857	633	582	526	521
Below Normal (13%)	504	566	652	737	823	899	860	690	470	480	420	343
Dry (24%)	348	396	487	624	727	836	845	773	667	574	359	289
Critical (15%)	283	279	317	482	581	630	631	563	482	336	182	147

Alternative 3 minus Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-46	17	-86	-18	0	0	0	0	-49	-68	-37	-27
20%	40	36	-88	-99	0	0	0	-43	-72	-16	51	1
30%	0	-42	-101	-213	-65	0	0	-53	-103	-8	8	20
40%	-25	-67	-53	-175	-145	-12	-35	-77	-138	-39	20	25
50%	-78	-23	-40	-162	-232	-130	-94	-107	-167	-47	15	-20
60%	-50	5	-10	-181	-292	-168	-191	-205	-185	-79	17	-76
70%	13	17	-41	-124	-282	-247	-224	-226	-193	-115	-63	58
80%	-14	15	-49	-177	-252	-335	-268	-280	-221	-112	-54	11
90%	0	-19	13	-145	-325	-408	-351	-276	-237	-154	-25	-60
Long Term												
Full Simulation Period ^b	-13	-8	-43	-135	-161	-140	-124	-136	-140	-59	-4	2
Water Year Types ^c												
Wet (32%)	-15	-17	-107	-151	-110	-52	-34	-41	-54	-15	24	9
Above Normal (16%)	-22	-18	-62	-195	-163	-124	-105	-100	-120	-52	31	56
Below Normal (13%)	-54	-49	-53	-204	-209	-160	-162	-230	-314	-191	-5	-16
Dry (24%)	24	45	57	-68	-173	-193	-167	-178	-153	-32	-45	-40
Critical (15%)	-22	-24	-41	-87	-205	-242	-233	-224	-169	-87	-31	10

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-5-3-6. San Luis Reservoir (SWP), End of Month Storage

Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	837	847	998	1,067	1,067	1,067	1,067	1,067	1,001	925	811	783
20%	623	695	894	1,067	1,067	1,067	1,067	1,063	911	769	571	617
30%	552	660	803	1,067	1,067	1,067	1,067	1,035	886	713	534	544
40%	482	579	680	977	1,067	1,067	1,067	1,002	849	681	501	494
50%	452	474	622	882	1,067	1,067	1,067	974	826	651	464	465
60%	352	406	487	800	1,066	1,067	1,067	948	779	628	419	414
70%	212	268	439	664	953	1,067	1,027	934	739	604	394	248
80%	133	166	287	585	850	1,029	994	883	702	539	344	186
90%	55	77	130	486	740	941	921	800	643	474	207	117
Long Term												
Full Simulation Period ^b	422	475	589	825	966	1,025	1,014	949	805	657	475	433
Water Year Types ^c												
Wet (32%)	517	595	756	960	1,049	1,066	1,066	1,030	898	809	661	665
Above Normal (16%)	377	462	618	898	1,010	1,049	1,043	957	753	635	495	465
Below Normal (13%)	558	616	705	941	1,032	1,060	1,023	920	784	671	426	359
Dry (24%)	324	352	430	692	901	1,029	1,012	951	820	606	404	329
Critical (15%)	306	304	358	569	786	872	863	787	651	422	213	137

Alternative 5

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	512	520	706	913	1,065	1,067	935	733	620	580	548	561
20%	431	476	577	750	867	1,013	899	664	489	492	478	500
30%	373	369	500	647	806	943	827	630	422	448	415	450
40%	334	318	463	573	724	874	764	566	381	379	358	403
50%	290	235	363	496	666	803	734	507	332	325	307	347
60%	201	194	285	432	618	750	639	460	289	296	251	271
70%	144	116	234	385	525	672	583	424	273	270	194	204
80%	66	66	176	344	446	583	552	369	233	217	113	84
90%	55	55	74	249	378	477	442	342	178	181	84	55
Long Term												
Full Simulation Period ^b	285	283	387	543	678	797	710	533	374	370	318	333
Water Year Types ^c												
Wet (32%)	347	350	433	594	758	912	805	609	459	466	475	513
Above Normal (16%)	275	276	416	579	712	842	727	505	306	309	329	394
Below Normal (13%)	315	286	407	533	641	749	649	451	235	258	255	260
Dry (24%)	249	258	375	530	652	760	690	532	398	420	262	243
Critical (15%)	193	187	256	428	546	603	572	476	350	249	120	95

Alternative 5 minus Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-325	-327	-292	-154	-2	0	-132	-334	-381	-345	-263	-223
20%	-192	-219	-317	-317	-200	-54	-168	-399	-421	-277	-93	-117
30%	-179	-291	-302	-420	-261	-124	-240	-405	-464	-265	-118	-94
40%	-148	-261	-217	-404	-343	-193	-303	-436	-468	-302	-144	-91
50%	-163	-239	-259	-386	-401	-264	-333	-467	-495	-326	-157	-117
60%	-151	-212	-202	-368	-448	-317	-428	-488	-490	-332	-168	-143
70%	-68	-152	-205	-279	-428	-395	-444	-509	-466	-333	-200	-44
80%	-67	-100	-111	-241	-404	-447	-442	-514	-469	-323	-231	-101
90%	0	-22	-56	-237	-361	-465	-479	-458	-465	-294	-124	-62
Long Term												
Full Simulation Period ^b	-137	-192	-203	-281	-288	-228	-304	-416	-431	-286	-156	-100
Water Year Types ^c												
Wet (32%)	-170	-245	-322	-366	-292	-153	-261	-421	-439	-342	-186	-152
Above Normal (16%)	-102	-187	-202	-319	-298	-207	-315	-452	-447	-326	-165	-71
Below Normal (13%)	-242	-330	-299	-408	-391	-310	-373	-469	-549	-412	-170	-98
Dry (24%)	-75	-94	-55	-162	-249	-269	-323	-419	-422	-186	-142	-86
Critical (15%)	-113	-116	-101	-141	-240	-269	-292	-311	-302	-173	-93	-42

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 C.6. New Melones Storage

Figure C-6-1. New Melones Reservoir, End of January Storage

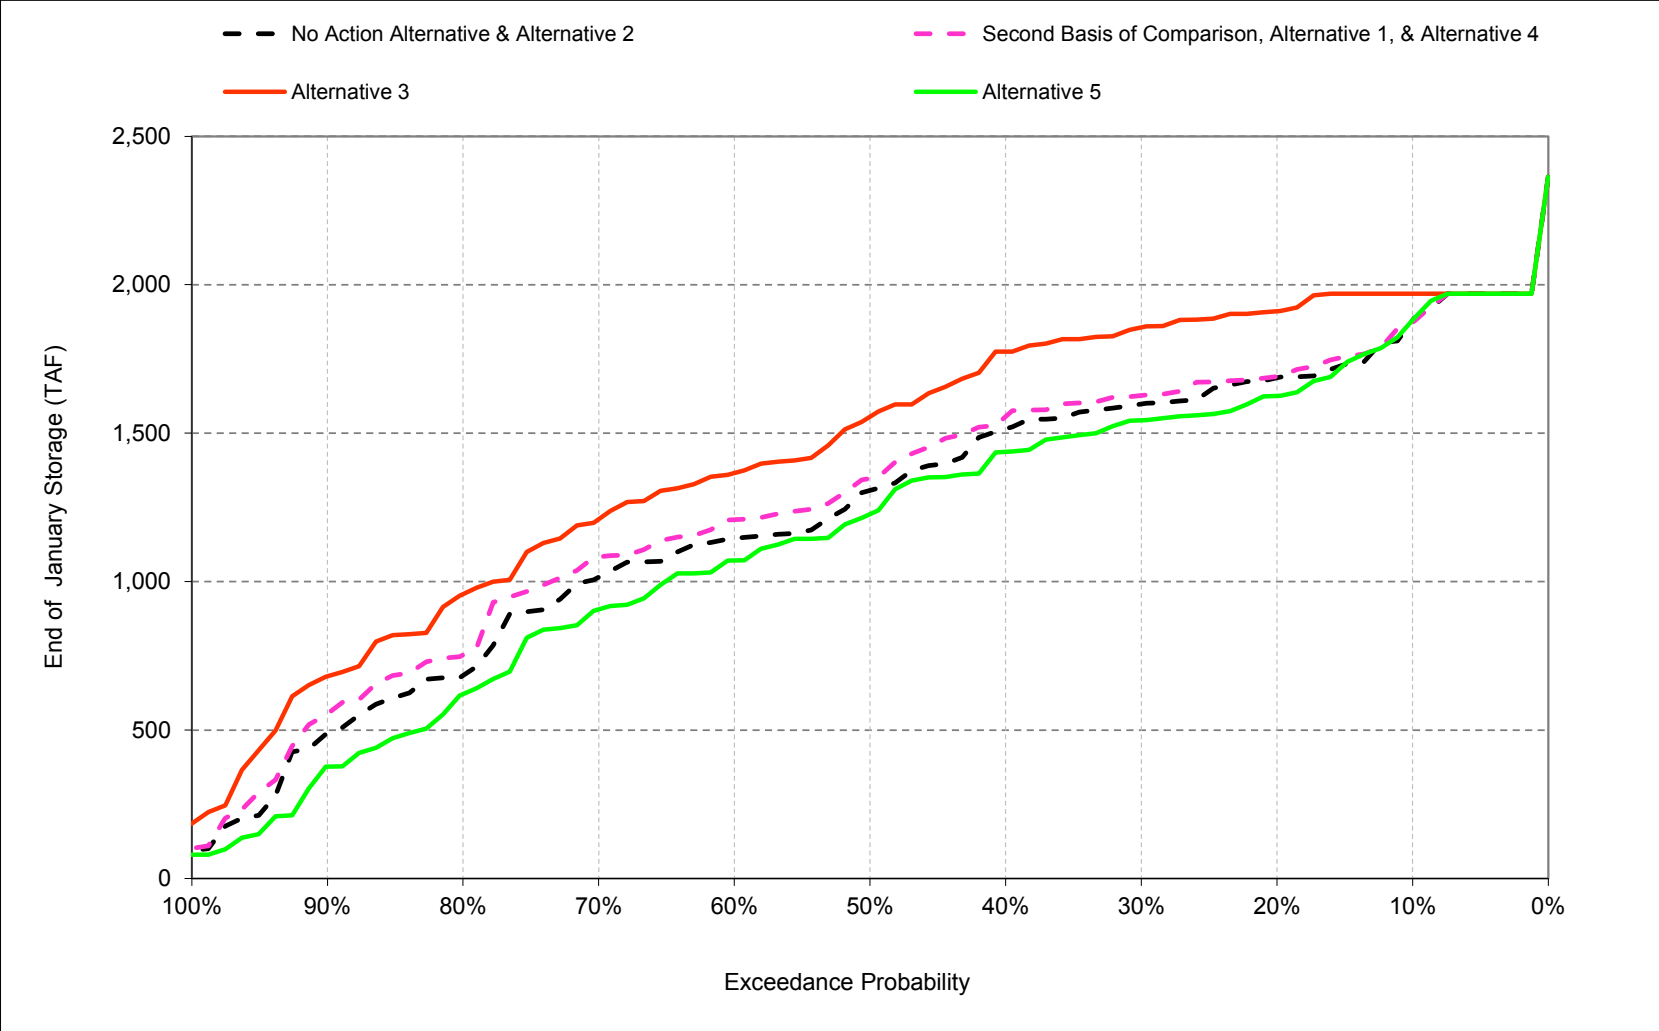


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-6-2. New Melones Reservoir, End of May Storage

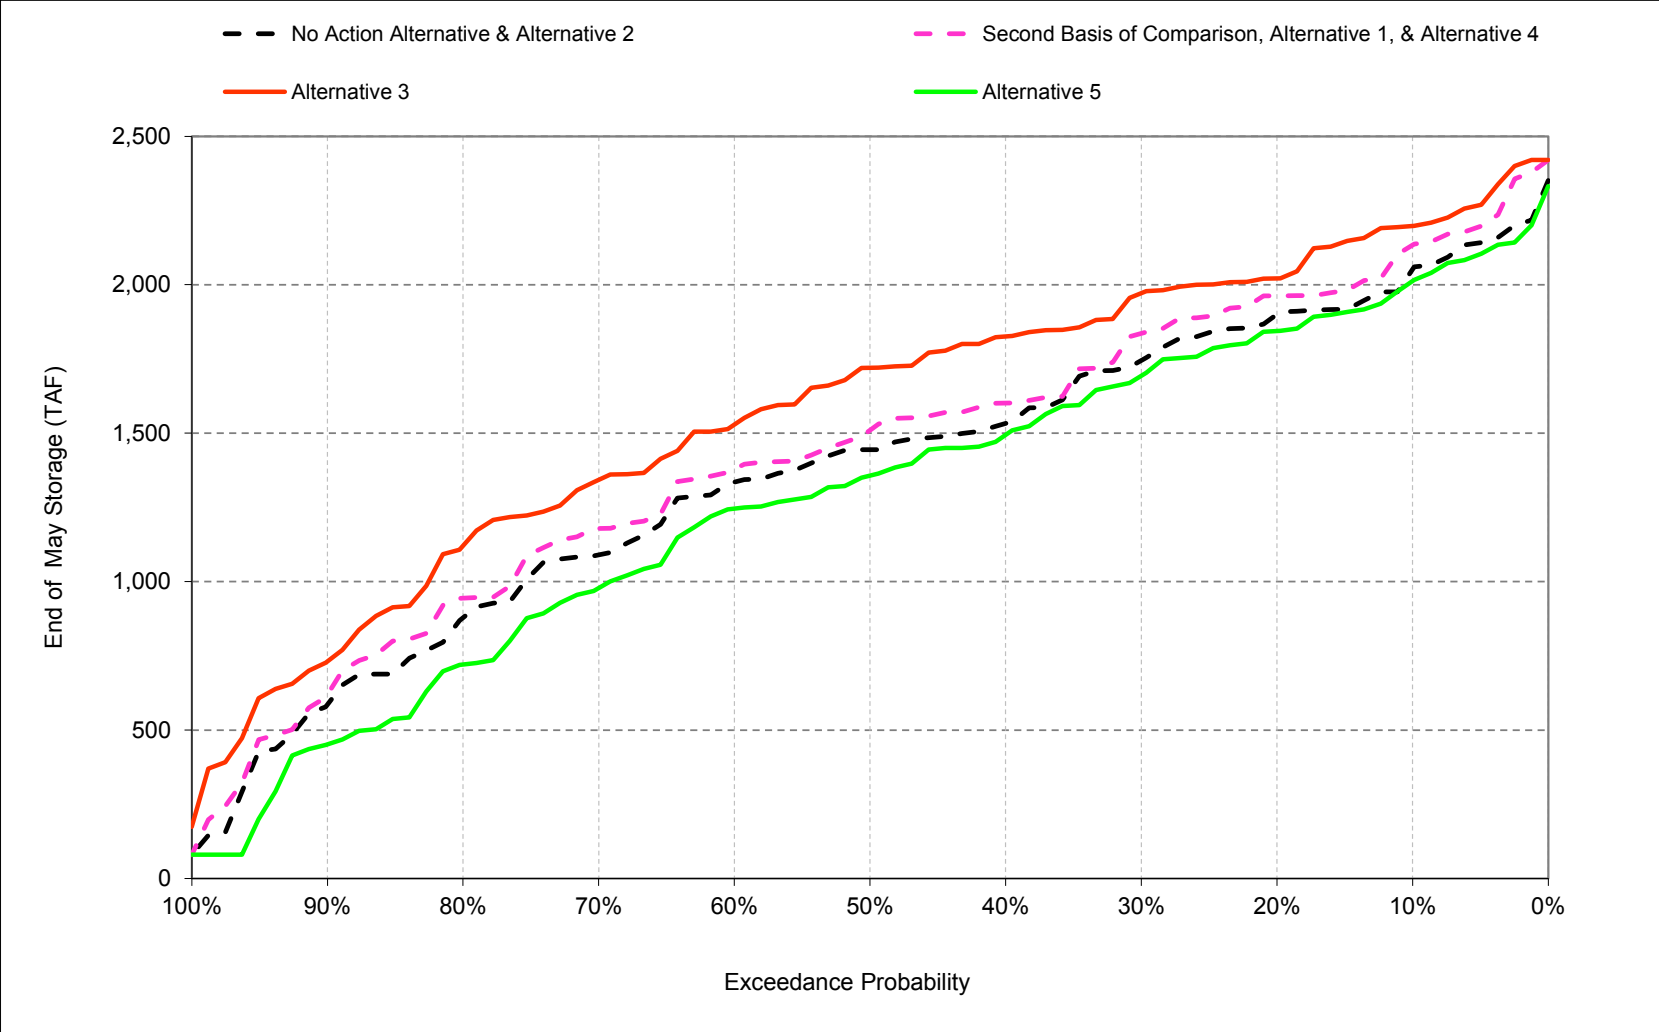

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-6-3. New Melones Reservoir, End of September Storage

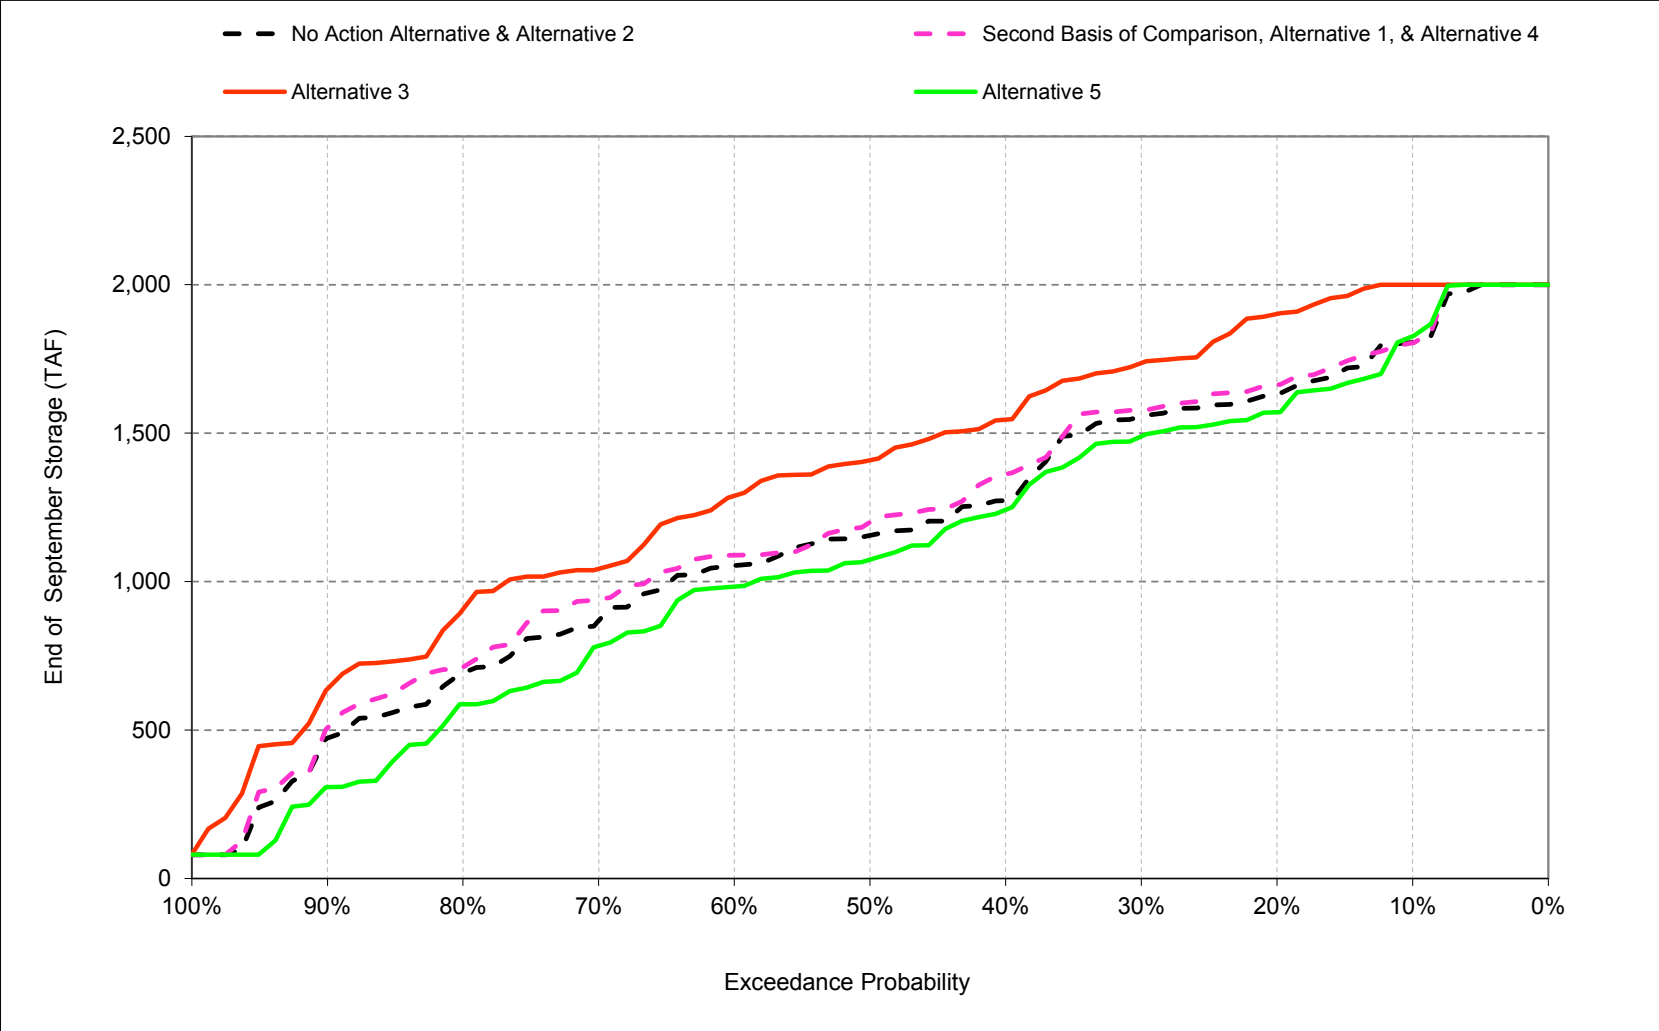

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-6-1. New Melones Reservoir, End of Month Storage

No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,765	1,759	1,823	1,880	1,931	1,980	1,945	2,052	2,075	1,978	1,869	1,805
20%	1,612	1,631	1,647	1,687	1,768	1,799	1,834	1,901	1,876	1,798	1,691	1,633
30%	1,533	1,534	1,556	1,598	1,686	1,729	1,686	1,745	1,786	1,707	1,605	1,556
40%	1,271	1,274	1,432	1,514	1,594	1,618	1,592	1,533	1,539	1,433	1,333	1,273
50%	1,121	1,127	1,154	1,307	1,436	1,535	1,461	1,444	1,392	1,283	1,190	1,156
60%	1,024	1,043	1,080	1,146	1,199	1,273	1,278	1,335	1,277	1,199	1,102	1,054
70%	882	911	986	1,015	1,038	1,057	1,080	1,090	1,087	994	910	868
80%	646	658	684	684	735	808	835	878	872	808	733	693
90%	430	435	440	488	541	569	574	586	630	566	507	473
Long Term												
Full Simulation Period ^b	1,132	1,142	1,180	1,237	1,305	1,348	1,337	1,373	1,381	1,300	1,208	1,159
Water Year Types^c												
Wet (32%)	1,379	1,390	1,454	1,562	1,666	1,724	1,758	1,878	1,968	1,890	1,773	1,703
Above Normal (16%)	1,029	1,060	1,125	1,214	1,317	1,406	1,413	1,484	1,467	1,372	1,277	1,232
Below Normal (13%)	1,294	1,305	1,326	1,351	1,413	1,438	1,390	1,383	1,359	1,268	1,175	1,133
Dry (24%)	1,094	1,094	1,106	1,121	1,156	1,188	1,154	1,132	1,087	997	914	871
Critical (15%)	624	623	638	645	661	656	602	554	526	476	431	408

Alternative 1												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,801	1,782	1,827	1,875	1,952	2,030	2,017	2,134	2,071	1,977	1,869	1,805
20%	1,657	1,655	1,665	1,690	1,847	1,928	1,884	1,963	1,884	1,830	1,719	1,663
30%	1,575	1,582	1,614	1,627	1,697	1,743	1,751	1,836	1,836	1,743	1,635	1,577
40%	1,366	1,372	1,472	1,556	1,621	1,675	1,649	1,601	1,619	1,510	1,415	1,362
50%	1,200	1,211	1,248	1,348	1,472	1,541	1,484	1,511	1,467	1,357	1,258	1,200
60%	1,089	1,093	1,124	1,209	1,259	1,341	1,373	1,379	1,317	1,224	1,134	1,089
70%	956	989	1,040	1,084	1,099	1,099	1,146	1,179	1,147	1,064	982	940
80%	711	712	730	753	825	932	914	945	903	837	758	712
90%	508	517	515	555	666	664	608	619	697	619	547	507
Long Term												
Full Simulation Period ^b	1,192	1,194	1,226	1,279	1,345	1,397	1,402	1,433	1,420	1,336	1,245	1,194
Water Year Types^c												
Wet (32%)	1,443	1,446	1,502	1,606	1,709	1,794	1,833	1,962	1,994	1,917	1,803	1,731
Above Normal (16%)	1,092	1,116	1,175	1,261	1,360	1,455	1,481	1,543	1,516	1,419	1,321	1,274
Below Normal (13%)	1,364	1,366	1,378	1,397	1,453	1,479	1,461	1,447	1,415	1,322	1,228	1,183
Dry (24%)	1,149	1,143	1,149	1,161	1,191	1,221	1,210	1,176	1,131	1,039	956	912
Critical (15%)	667	663	674	680	696	690	646	585	557	498	449	426

Alternative 1 minus No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	35	22	4	-5	21	50	71	81	-4	-2	0	-1
20%	45	24	19	4	79	129	50	62	7	33	28	30
30%	42	48	59	29	11	15	65	92	51	36	31	21
40%	94	98	40	42	27	58	56	68	80	77	82	89
50%	79	84	95	40	36	7	23	66	75	74	68	45
60%	64	51	44	63	60	68	95	44	41	25	32	35
70%	75	77	54	69	61	42	66	89	59	69	72	71
80%	66	54	46	69	91	124	79	66	31	28	25	19
90%	77	82	76	67	126	94	34	33	67	53	40	35
Long Term												
Full Simulation Period ^b	59	53	46	42	40	48	64	60	38	37	36	35
Water Year Types^c												
Wet (32%)	64	56	49	44	43	70	75	84	25	27	30	28
Above Normal (16%)	62	56	50	46	43	48	68	59	49	46	44	42
Below Normal (13%)	69	61	52	46	40	41	71	63	55	54	52	51
Dry (24%)	55	49	43	40	35	33	56	45	44	43	42	42
Critical (15%)	44	40	37	36	35	34	45	31	31	23	18	18

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-6-2. New Melones Reservoir, End of Month Storage

No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,765	1,759	1,823	1,880	1,931	1,980	1,945	2,052	2,075	1,978	1,869	1,805
20%	1,612	1,631	1,647	1,687	1,768	1,799	1,834	1,901	1,876	1,798	1,691	1,633
30%	1,533	1,534	1,556	1,598	1,686	1,729	1,686	1,745	1,786	1,707	1,605	1,556
40%	1,271	1,274	1,432	1,514	1,594	1,618	1,592	1,533	1,539	1,433	1,333	1,273
50%	1,121	1,127	1,154	1,307	1,436	1,535	1,461	1,444	1,392	1,283	1,190	1,156
60%	1,024	1,043	1,080	1,146	1,199	1,273	1,278	1,335	1,277	1,199	1,102	1,054
70%	882	911	986	1,015	1,038	1,057	1,080	1,090	1,087	994	910	868
80%	646	658	684	684	735	808	835	878	872	808	733	693
90%	430	435	440	488	541	569	574	586	630	566	507	473
Long Term												
Full Simulation Period ^b	1,132	1,142	1,180	1,237	1,305	1,348	1,337	1,373	1,381	1,300	1,208	1,159
Water Year Types^c												
Wet (32%)	1,379	1,390	1,454	1,562	1,666	1,724	1,758	1,878	1,968	1,890	1,773	1,703
Above Normal (16%)	1,029	1,060	1,125	1,214	1,317	1,406	1,413	1,484	1,467	1,372	1,277	1,232
Below Normal (13%)	1,294	1,305	1,326	1,351	1,413	1,438	1,390	1,383	1,359	1,268	1,175	1,133
Dry (24%)	1,094	1,094	1,106	1,121	1,156	1,188	1,154	1,132	1,087	997	914	871
Critical (15%)	624	623	638	645	661	656	602	554	526	476	431	408

Alternative 3												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,967	1,954	1,970	1,970	1,970	2,030	2,062	2,198	2,284	2,209	2,103	2,000
20%	1,901	1,905	1,913	1,911	1,970	2,026	1,988	2,021	2,154	2,055	1,955	1,902
30%	1,729	1,727	1,790	1,857	1,925	1,975	1,910	1,972	1,983	1,877	1,785	1,736
40%	1,582	1,596	1,668	1,775	1,851	1,884	1,838	1,826	1,796	1,697	1,601	1,546
50%	1,427	1,416	1,439	1,556	1,660	1,719	1,674	1,721	1,675	1,561	1,460	1,409
60%	1,308	1,316	1,318	1,366	1,426	1,494	1,488	1,529	1,525	1,432	1,335	1,289
70%	1,049	1,073	1,187	1,210	1,289	1,269	1,265	1,343	1,276	1,180	1,092	1,043
80%	875	862	919	957	1,020	1,099	1,056	1,121	1,071	1,001	938	907
90%	635	646	646	681	779	803	734	731	835	756	682	639
Long Term												
Full Simulation Period ^b	1,347	1,351	1,382	1,436	1,491	1,541	1,534	1,580	1,595	1,506	1,408	1,353
Water Year Types^c												
Wet (32%)	1,562	1,567	1,618	1,720	1,792	1,871	1,906	2,049	2,146	2,057	1,934	1,855
Above Normal (16%)	1,269	1,295	1,356	1,442	1,530	1,620	1,634	1,713	1,720	1,627	1,529	1,481
Below Normal (13%)	1,530	1,536	1,550	1,570	1,620	1,650	1,614	1,617	1,599	1,501	1,403	1,357
Dry (24%)	1,327	1,320	1,326	1,342	1,378	1,409	1,380	1,360	1,319	1,224	1,137	1,091
Critical (15%)	828	824	836	846	866	860	803	751	719	653	593	563

Alternative 3 minus No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	202	194	147	90	39	50	117	146	209	231	233	195
20%	289	275	266	224	202	227	155	121	277	257	264	269
30%	196	192	234	259	238	246	224	227	197	170	180	180
40%	311	322	236	260	257	266	245	293	256	264	268	273
50%	306	288	286	248	224	185	213	276	283	279	271	253
60%	284	274	238	220	228	221	210	194	249	234	233	235
70%	167	162	201	195	251	213	185	252	188	186	182	175
80%	230	204	235	273	285	290	221	243	198	193	205	214
90%	205	212	206	193	239	234	159	145	206	190	175	167
Long Term												
Full Simulation Period ^b	214	209	202	199	186	193	197	206	213	206	200	194
Water Year Types^c												
Wet (32%)	183	177	165	158	126	147	149	172	178	168	161	152
Above Normal (16%)	239	235	231	228	213	213	220	229	253	255	252	250
Below Normal (13%)	236	231	224	219	207	212	224	234	239	233	228	224
Dry (24%)	232	226	220	220	222	221	226	228	232	228	223	221
Critical (15%)	205	201	198	201	204	204	202	197	193	177	162	154

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-6-3. New Melones Reservoir, End of Month Storage

No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1,765	1,759	1,823	1,880	1,931	1,980	1,945	2,052	2,075	1,978	1,869	1,805
20%	1,612	1,631	1,647	1,687	1,768	1,799	1,834	1,901	1,876	1,798	1,691	1,633
30%	1,533	1,534	1,556	1,598	1,686	1,729	1,686	1,745	1,786	1,707	1,605	1,556
40%	1,271	1,274	1,432	1,514	1,594	1,618	1,592	1,533	1,539	1,433	1,333	1,273
50%	1,121	1,127	1,154	1,307	1,436	1,535	1,461	1,444	1,392	1,283	1,190	1,156
60%	1,024	1,043	1,080	1,146	1,199	1,273	1,278	1,335	1,277	1,199	1,102	1,054
70%	882	911	986	1,015	1,038	1,057	1,080	1,090	1,087	994	910	868
80%	646	658	684	684	735	808	835	878	872	808	733	693
90%	430	435	440	488	541	569	574	586	630	566	507	473
Long Term												
Full Simulation Period ^b	1,132	1,142	1,180	1,237	1,305	1,348	1,337	1,373	1,381	1,300	1,208	1,159
Water Year Types ^c												
Wet (32%)	1,379	1,390	1,454	1,562	1,666	1,724	1,758	1,878	1,968	1,890	1,773	1,703
Above Normal (16%)	1,029	1,060	1,125	1,214	1,317	1,406	1,413	1,484	1,467	1,372	1,277	1,232
Below Normal (13%)	1,294	1,305	1,326	1,351	1,413	1,438	1,390	1,383	1,359	1,268	1,175	1,133
Dry (24%)	1,094	1,094	1,106	1,121	1,156	1,188	1,154	1,132	1,087	997	914	871
Critical (15%)	624	623	638	645	661	656	602	554	526	476	431	408

Alternative 5												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1,765	1,759	1,831	1,881	1,949	1,969	1,908	2,012	2,117	2,013	1,900	1,826
20%	1,588	1,587	1,601	1,626	1,782	1,794	1,752	1,844	1,816	1,740	1,631	1,571
30%	1,468	1,459	1,490	1,544	1,630	1,672	1,679	1,693	1,721	1,633	1,531	1,489
40%	1,249	1,252	1,347	1,437	1,522	1,573	1,512	1,494	1,505	1,405	1,297	1,242
50%	1,040	1,058	1,142	1,227	1,437	1,455	1,393	1,357	1,289	1,190	1,100	1,074
60%	976	997	1,023	1,072	1,134	1,161	1,159	1,246	1,218	1,130	1,032	983
70%	766	802	855	907	938	973	1,006	978	991	900	821	783
80%	554	553	620	621	623	697	651	721	761	686	617	587
90%	285	298	299	377	429	449	386	452	492	423	349	308
Long Term												
Full Simulation Period ^b	1,063	1,073	1,112	1,169	1,239	1,284	1,265	1,287	1,299	1,221	1,134	1,086
Water Year Types ^c												
Wet (32%)	1,309	1,321	1,388	1,496	1,602	1,668	1,704	1,812	1,906	1,833	1,722	1,653
Above Normal (16%)	983	1,014	1,079	1,168	1,271	1,361	1,363	1,413	1,396	1,302	1,207	1,162
Below Normal (13%)	1,210	1,220	1,242	1,267	1,329	1,354	1,298	1,276	1,254	1,163	1,071	1,028
Dry (24%)	1,018	1,018	1,030	1,045	1,081	1,114	1,066	1,031	990	903	823	781
Critical (15%)	558	559	570	578	597	591	506	449	433	391	355	336

Alternative 5 minus No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-1	0	8	1	18	-11	-37	-40	42	35	31	21
20%	-24	-44	-46	-61	13	-5	-82	-56	-60	-58	-60	-62
30%	-65	-75	-65	-54	-56	-57	-7	-52	-64	-73	-74	-67
40%	-22	-22	-85	-77	-72	-45	-81	-39	-34	-28	-36	-31
50%	-81	-69	-11	-80	1	-80	-68	-87	-104	-93	-89	-82
60%	-48	-46	-57	-74	-65	-112	-119	-89	-59	-69	-70	-71
70%	-116	-109	-131	-108	-100	-84	-74	-112	-96	-94	-90	-85
80%	-92	-105	-64	-63	-112	-112	-184	-157	-111	-122	-116	-106
90%	-145	-137	-141	-111	-112	-120	-188	-134	-138	-144	-158	-164
Long Term												
Full Simulation Period ^b	-69	-69	-68	-68	-67	-64	-73	-86	-82	-79	-75	-73
Water Year Types ^c												
Wet (32%)	-70	-69	-65	-66	-64	-56	-54	-65	-62	-57	-51	-49
Above Normal (16%)	-46	-46	-46	-46	-46	-46	-51	-71	-71	-70	-70	-70
Below Normal (13%)	-84	-84	-84	-84	-84	-84	-93	-107	-106	-105	-105	-104
Dry (24%)	-77	-76	-76	-76	-75	-74	-88	-100	-97	-94	-91	-89
Critical (15%)	-66	-64	-68	-66	-64	-65	-95	-105	-93	-84	-76	-73

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-6-4. New Melones Reservoir, End of Month Storage

Second Basis of Comparison												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,801	1,782	1,827	1,875	1,952	2,030	2,017	2,134	2,071	1,977	1,869	1,805
20%	1,657	1,655	1,665	1,690	1,847	1,928	1,884	1,963	1,884	1,830	1,719	1,663
30%	1,575	1,582	1,614	1,627	1,697	1,743	1,751	1,836	1,836	1,743	1,635	1,577
40%	1,366	1,372	1,472	1,556	1,621	1,675	1,649	1,601	1,619	1,510	1,415	1,362
50%	1,200	1,211	1,248	1,348	1,472	1,541	1,484	1,511	1,467	1,357	1,258	1,200
60%	1,089	1,093	1,124	1,209	1,259	1,341	1,373	1,379	1,317	1,224	1,134	1,089
70%	956	989	1,040	1,084	1,099	1,099	1,146	1,179	1,147	1,064	982	940
80%	711	712	730	753	825	932	914	945	903	837	758	712
90%	508	517	515	555	666	664	608	619	697	619	547	507
Long Term												
Full Simulation Period ^b	1,192	1,194	1,226	1,279	1,345	1,397	1,402	1,433	1,420	1,336	1,245	1,194
Water Year Types^c												
Wet (32%)	1,443	1,446	1,502	1,606	1,709	1,794	1,833	1,962	1,994	1,917	1,803	1,731
Above Normal (16%)	1,092	1,116	1,175	1,261	1,360	1,455	1,481	1,543	1,516	1,419	1,321	1,274
Below Normal (13%)	1,364	1,366	1,378	1,397	1,453	1,479	1,461	1,447	1,415	1,322	1,228	1,183
Dry (24%)	1,149	1,143	1,149	1,161	1,191	1,221	1,210	1,176	1,131	1,039	956	912
Critical (15%)	667	663	674	680	696	690	646	585	557	498	449	426

No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,765	1,759	1,823	1,880	1,931	1,980	1,945	2,052	2,075	1,978	1,869	1,805
20%	1,612	1,631	1,647	1,687	1,768	1,799	1,834	1,901	1,876	1,798	1,691	1,633
30%	1,533	1,534	1,556	1,598	1,686	1,729	1,686	1,745	1,786	1,707	1,605	1,556
40%	1,271	1,274	1,432	1,514	1,594	1,618	1,592	1,533	1,539	1,433	1,333	1,273
50%	1,121	1,127	1,154	1,307	1,436	1,535	1,461	1,444	1,392	1,283	1,190	1,156
60%	1,024	1,043	1,080	1,146	1,199	1,273	1,278	1,335	1,277	1,199	1,102	1,054
70%	882	911	986	1,015	1,038	1,057	1,080	1,090	1,087	994	910	868
80%	646	658	684	684	735	808	835	878	872	808	733	693
90%	430	435	440	488	541	569	574	586	630	566	507	473
Long Term												
Full Simulation Period ^b	1,132	1,142	1,180	1,237	1,305	1,348	1,337	1,373	1,381	1,300	1,208	1,159
Water Year Types^c												
Wet (32%)	1,379	1,390	1,454	1,562	1,666	1,724	1,758	1,878	1,968	1,890	1,773	1,703
Above Normal (16%)	1,029	1,060	1,125	1,214	1,317	1,406	1,413	1,484	1,467	1,372	1,277	1,232
Below Normal (13%)	1,294	1,305	1,326	1,351	1,413	1,438	1,390	1,383	1,359	1,268	1,175	1,133
Dry (24%)	1,094	1,094	1,106	1,121	1,156	1,188	1,154	1,132	1,087	997	914	871
Critical (15%)	624	623	638	645	661	656	602	554	526	476	431	408

No Action Alternative minus Second Basis of Comparison												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-35	-22	-4	5	-21	-50	-71	-81	4	2	0	1
20%	-45	-24	-19	-4	-79	-129	-50	-62	-7	-33	-28	-30
30%	-42	-48	-59	-29	-11	-15	-65	-92	-51	-36	-31	-21
40%	-94	-98	-40	-42	-27	-58	-56	-68	-80	-77	-82	-89
50%	-79	-84	-95	-40	-36	-7	-23	-66	-75	-74	-68	-45
60%	-64	-51	-44	-63	-60	-68	-95	-44	-41	-25	-32	-35
70%	-75	-77	-54	-69	-61	-42	-66	-89	-59	-69	-72	-71
80%	-66	-54	-46	-69	-91	-124	-79	-66	-31	-28	-25	-19
90%	-77	-82	-76	-67	-126	-94	-34	-33	-67	-53	-40	-35
Long Term												
Full Simulation Period ^b	-59	-53	-46	-42	-40	-48	-64	-60	-38	-37	-36	-35
Water Year Types^c												
Wet (32%)	-64	-56	-49	-44	-43	-70	-75	-84	-25	-27	-30	-28
Above Normal (16%)	-62	-56	-50	-46	-43	-48	-68	-59	-49	-46	-44	-42
Below Normal (13%)	-69	-61	-52	-46	-40	-41	-71	-63	-55	-54	-52	-51
Dry (24%)	-55	-49	-43	-40	-35	-33	-56	-45	-44	-43	-42	-42
Critical (15%)	-44	-40	-37	-36	-35	-34	-45	-31	-31	-23	-18	-18

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-6-5. New Melones Reservoir, End of Month Storage

Second Basis of Comparison												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,801	1,782	1,827	1,875	1,952	2,030	2,017	2,134	2,071	1,977	1,869	1,805
20%	1,657	1,655	1,665	1,690	1,847	1,928	1,884	1,963	1,884	1,830	1,719	1,663
30%	1,575	1,582	1,614	1,627	1,697	1,743	1,751	1,836	1,836	1,743	1,635	1,577
40%	1,366	1,372	1,472	1,556	1,621	1,675	1,649	1,601	1,619	1,510	1,415	1,362
50%	1,200	1,211	1,248	1,348	1,472	1,541	1,484	1,511	1,467	1,357	1,258	1,200
60%	1,089	1,093	1,124	1,209	1,259	1,341	1,373	1,379	1,317	1,224	1,134	1,089
70%	956	989	1,040	1,084	1,099	1,099	1,146	1,179	1,147	1,064	982	940
80%	711	712	730	753	825	932	914	945	903	837	758	712
90%	508	517	515	555	666	664	608	619	697	619	547	507
Long Term												
Full Simulation Period ^b	1,192	1,194	1,226	1,279	1,345	1,397	1,402	1,433	1,420	1,336	1,245	1,194
Water Year Types^c												
Wet (32%)	1,443	1,446	1,502	1,606	1,709	1,794	1,833	1,962	1,994	1,917	1,803	1,731
Above Normal (16%)	1,092	1,116	1,175	1,261	1,360	1,455	1,481	1,543	1,516	1,419	1,321	1,274
Below Normal (13%)	1,364	1,366	1,378	1,397	1,453	1,479	1,461	1,447	1,415	1,322	1,228	1,183
Dry (24%)	1,149	1,143	1,149	1,161	1,191	1,221	1,210	1,176	1,131	1,039	956	912
Critical (15%)	667	663	674	680	696	690	646	585	557	498	449	426

Alternative 3

End of Month Storage (TAF)												
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,967	1,954	1,970	1,970	1,970	2,030	2,062	2,198	2,284	2,209	2,103	2,000
20%	1,901	1,905	1,913	1,911	1,970	2,026	1,988	2,021	2,154	2,055	1,955	1,902
30%	1,729	1,727	1,790	1,857	1,925	1,975	1,910	1,972	1,983	1,877	1,785	1,736
40%	1,582	1,596	1,668	1,775	1,851	1,884	1,838	1,826	1,796	1,697	1,601	1,546
50%	1,427	1,416	1,439	1,556	1,660	1,719	1,674	1,721	1,675	1,561	1,460	1,409
60%	1,308	1,316	1,318	1,366	1,426	1,494	1,488	1,529	1,525	1,432	1,335	1,289
70%	1,049	1,073	1,187	1,210	1,289	1,269	1,265	1,343	1,276	1,180	1,092	1,043
80%	875	862	919	957	1,020	1,099	1,056	1,121	1,071	1,001	938	907
90%	635	646	646	681	779	803	734	731	835	756	682	639
Long Term												
Full Simulation Period ^b	1,347	1,351	1,382	1,436	1,491	1,541	1,534	1,580	1,595	1,506	1,408	1,353
Water Year Types^c												
Wet (32%)	1,562	1,567	1,618	1,720	1,792	1,871	1,906	2,049	2,146	2,057	1,934	1,855
Above Normal (16%)	1,269	1,295	1,356	1,442	1,530	1,620	1,634	1,713	1,720	1,627	1,529	1,481
Below Normal (13%)	1,530	1,536	1,550	1,570	1,620	1,650	1,614	1,617	1,599	1,501	1,403	1,357
Dry (24%)	1,327	1,320	1,326	1,342	1,378	1,409	1,380	1,360	1,319	1,224	1,137	1,091
Critical (15%)	828	824	836	846	866	860	803	751	719	653	593	563

Alternative 3 minus Second Basis of Comparison

End of Month Storage (TAF)												
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	167	172	143	95	18	0	45	65	213	233	234	195
20%	244	251	247	220	123	98	105	59	270	224	236	239
30%	154	144	175	229	228	232	159	135	147	134	149	159
40%	217	224	196	219	230	209	189	225	176	187	186	184
50%	227	205	191	208	188	178	190	210	208	205	202	209
60%	220	223	194	157	168	153	115	150	208	209	201	200
70%	92	85	147	126	190	170	119	164	129	116	110	104
80%	164	150	190	205	194	167	142	176	168	165	180	195
90%	127	130	131	126	113	139	126	112	138	137	134	132
Long Term												
Full Simulation Period ^b	155	156	155	156	146	144	132	146	175	169	163	159
Water Year Types^c												
Wet (32%)	119	121	116	114	83	77	73	88	153	141	131	124
Above Normal (16%)	177	179	181	181	170	165	153	170	204	208	207	208
Below Normal (13%)	167	170	172	173	167	170	153	170	184	179	175	174
Dry (24%)	177	177	177	181	187	188	170	183	188	185	181	179
Critical (15%)	161	161	162	165	170	170	157	166	162	155	144	137

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-6-6. New Melones Reservoir, End of Month Storage

Second Basis of Comparison												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,801	1,782	1,827	1,875	1,952	2,030	2,017	2,134	2,071	1,977	1,869	1,805
20%	1,657	1,655	1,665	1,690	1,847	1,928	1,884	1,963	1,884	1,830	1,719	1,663
30%	1,575	1,582	1,614	1,627	1,697	1,743	1,751	1,836	1,836	1,743	1,635	1,577
40%	1,366	1,372	1,472	1,556	1,621	1,675	1,649	1,601	1,619	1,510	1,415	1,362
50%	1,200	1,211	1,248	1,348	1,472	1,541	1,484	1,511	1,467	1,357	1,258	1,200
60%	1,089	1,093	1,124	1,209	1,259	1,341	1,373	1,379	1,317	1,224	1,134	1,089
70%	956	989	1,040	1,084	1,099	1,099	1,146	1,179	1,147	1,064	982	940
80%	711	712	730	753	825	932	914	945	903	837	758	712
90%	508	517	515	555	666	664	608	619	697	619	547	507
Long Term												
Full Simulation Period ^b	1,192	1,194	1,226	1,279	1,345	1,397	1,402	1,433	1,420	1,336	1,245	1,194
Water Year Types^c												
Wet (32%)	1,443	1,446	1,502	1,606	1,709	1,794	1,833	1,962	1,994	1,917	1,803	1,731
Above Normal (16%)	1,092	1,116	1,175	1,261	1,360	1,455	1,481	1,543	1,516	1,419	1,321	1,274
Below Normal (13%)	1,364	1,366	1,378	1,397	1,453	1,479	1,461	1,447	1,415	1,322	1,228	1,183
Dry (24%)	1,149	1,143	1,149	1,161	1,191	1,221	1,210	1,176	1,131	1,039	956	912
Critical (15%)	667	663	674	680	696	690	646	585	557	498	449	426

Alternative 5

End of Month Storage (TAF)												
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,765	1,759	1,831	1,881	1,949	1,969	1,908	2,012	2,117	2,013	1,900	1,826
20%	1,588	1,587	1,601	1,626	1,782	1,794	1,752	1,844	1,816	1,740	1,631	1,571
30%	1,468	1,459	1,490	1,544	1,630	1,672	1,679	1,693	1,721	1,633	1,531	1,489
40%	1,249	1,252	1,347	1,437	1,522	1,573	1,512	1,494	1,505	1,405	1,297	1,242
50%	1,040	1,058	1,142	1,227	1,437	1,455	1,393	1,357	1,289	1,190	1,100	1,074
60%	976	997	1,023	1,072	1,134	1,161	1,159	1,246	1,218	1,130	1,032	983
70%	766	802	855	907	938	973	1,006	978	991	900	821	783
80%	554	553	620	621	623	697	651	721	761	686	617	587
90%	285	298	299	377	429	449	386	452	492	423	349	308
Long Term												
Full Simulation Period ^b	1,063	1,073	1,112	1,169	1,239	1,284	1,265	1,287	1,299	1,221	1,134	1,086
Water Year Types^c												
Wet (32%)	1,309	1,321	1,388	1,496	1,602	1,668	1,704	1,812	1,906	1,833	1,722	1,653
Above Normal (16%)	983	1,014	1,079	1,168	1,271	1,361	1,363	1,413	1,396	1,302	1,207	1,162
Below Normal (13%)	1,210	1,220	1,242	1,267	1,329	1,354	1,298	1,276	1,254	1,163	1,071	1,028
Dry (24%)	1,018	1,018	1,030	1,045	1,081	1,114	1,066	1,031	990	903	823	781
Critical (15%)	558	559	570	578	597	591	506	449	433	391	355	336

Alternative 5 minus Second Basis of Comparison

End of Month Storage (TAF)												
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-36	-22	4	6	-3	-61	-108	-122	46	37	31	21
20%	-69	-67	-65	-65	-66	-134	-132	-118	-68	-90	-88	-92
30%	-107	-123	-124	-83	-67	-72	-71	-143	-115	-109	-104	-88
40%	-116	-120	-126	-119	-99	-103	-137	-108	-114	-105	-118	-120
50%	-161	-153	-106	-121	-35	-86	-90	-154	-178	-167	-158	-127
60%	-112	-97	-102	-137	-125	-180	-214	-133	-100	-94	-102	-106
70%	-190	-187	-185	-177	-161	-126	-140	-201	-156	-163	-162	-156
80%	-157	-159	-109	-132	-203	-235	-263	-224	-142	-150	-141	-125
90%	-222	-219	-216	-178	-238	-215	-221	-167	-206	-196	-198	-199
Long Term												
Full Simulation Period ^b	-128	-121	-114	-110	-106	-112	-137	-146	-121	-115	-111	-108
Water Year Types^c												
Wet (32%)	-134	-125	-114	-110	-108	-126	-129	-149	-88	-84	-81	-77
Above Normal (16%)	-108	-102	-96	-92	-89	-94	-118	-130	-120	-117	-114	-112
Below Normal (13%)	-154	-145	-137	-130	-124	-125	-164	-170	-161	-159	-157	-155
Dry (24%)	-132	-125	-119	-116	-110	-107	-144	-145	-141	-136	-133	-131
Critical (15%)	-109	-104	-104	-102	-99	-99	-140	-136	-123	-107	-95	-90

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 **C.7. Millerton Storage**

Figure C-7-1. Millerton Lake, End of October Storage

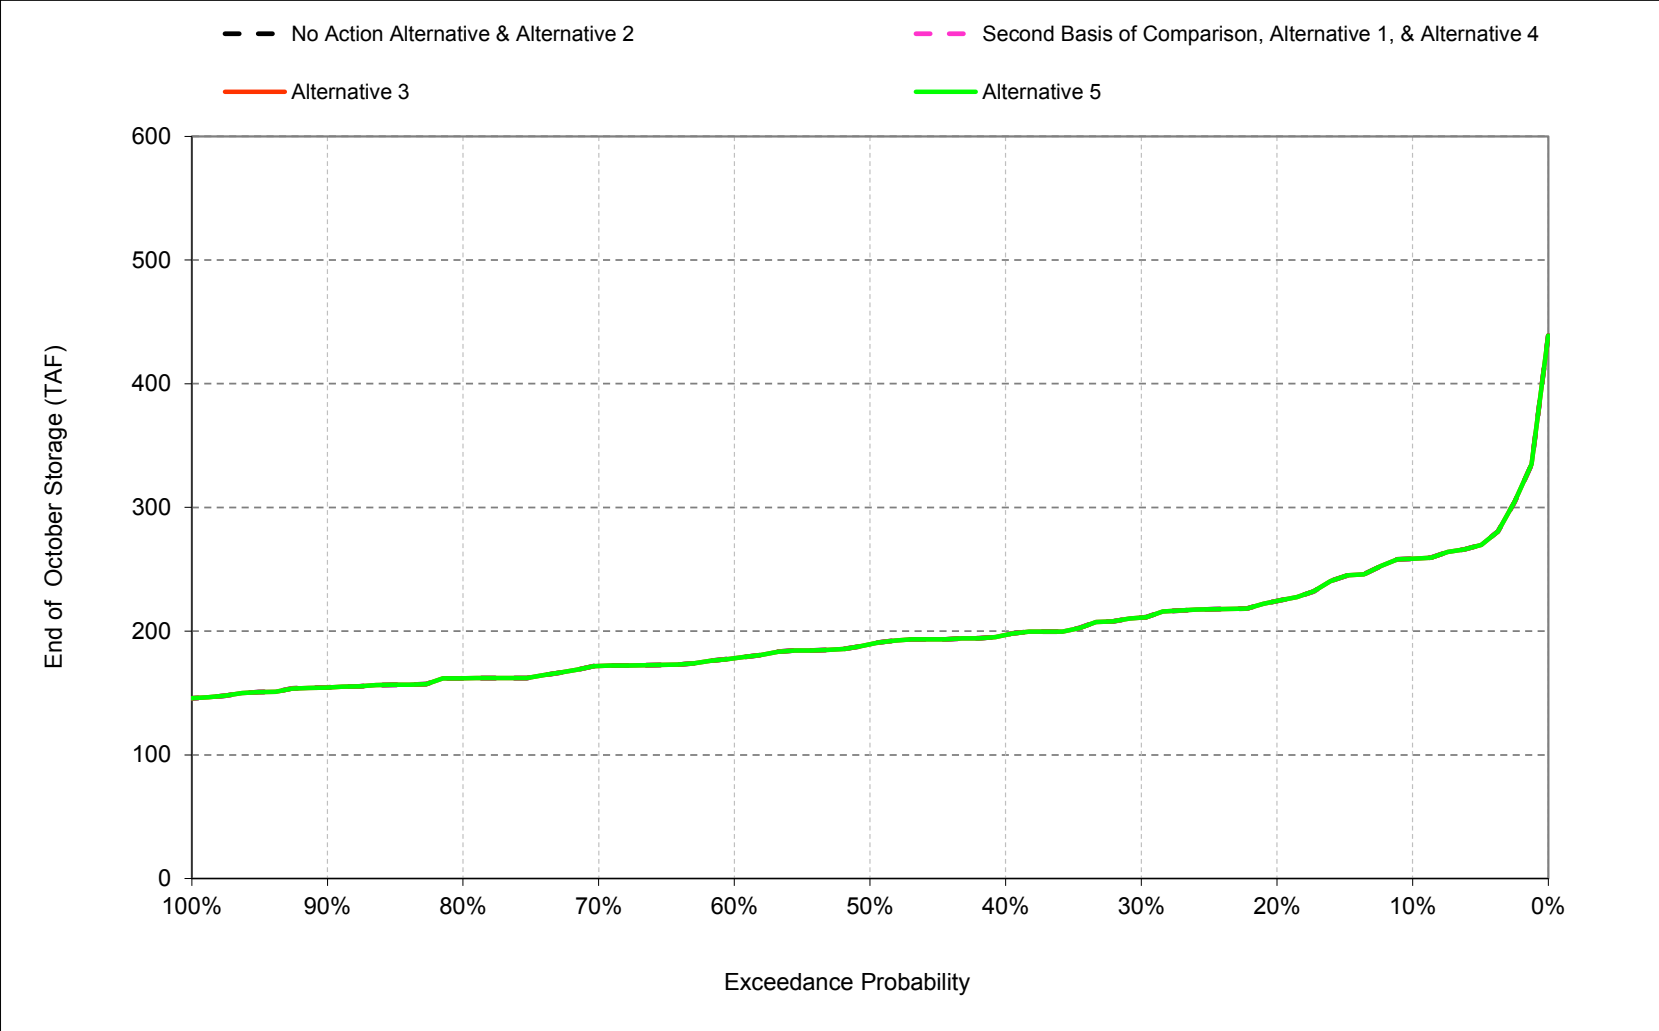


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-7-2. Millerton Lake, End of November Storage

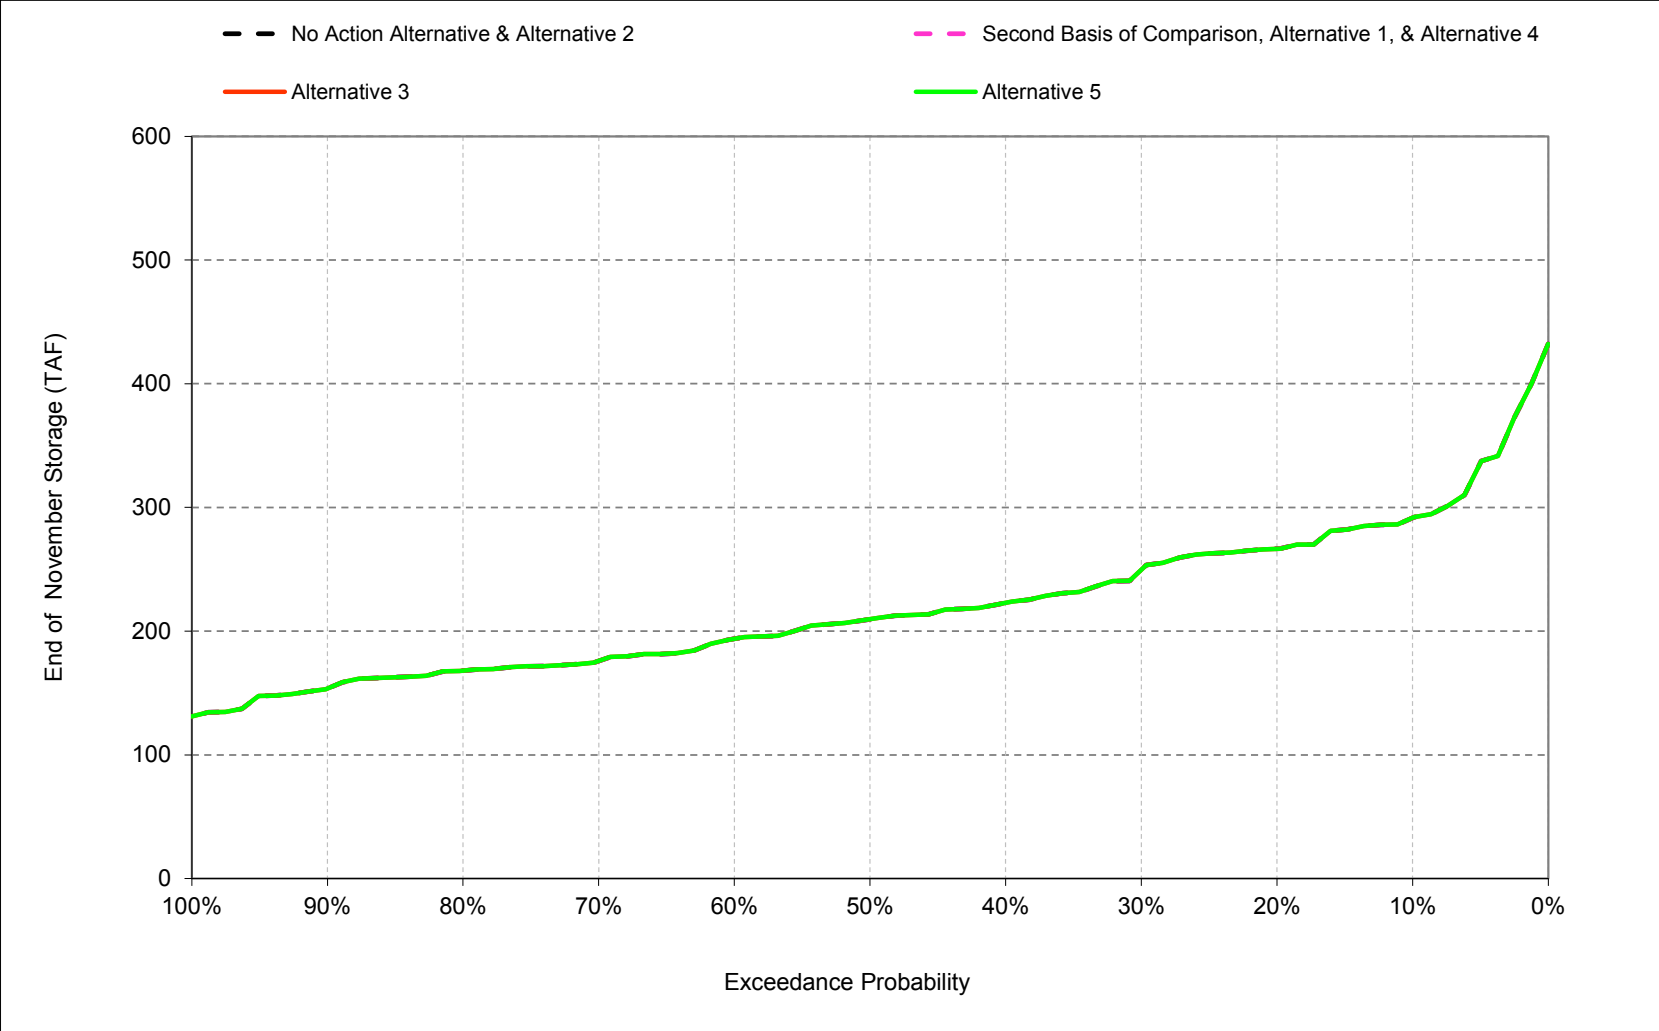


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-7-3. Millerton Lake, End of December Storage

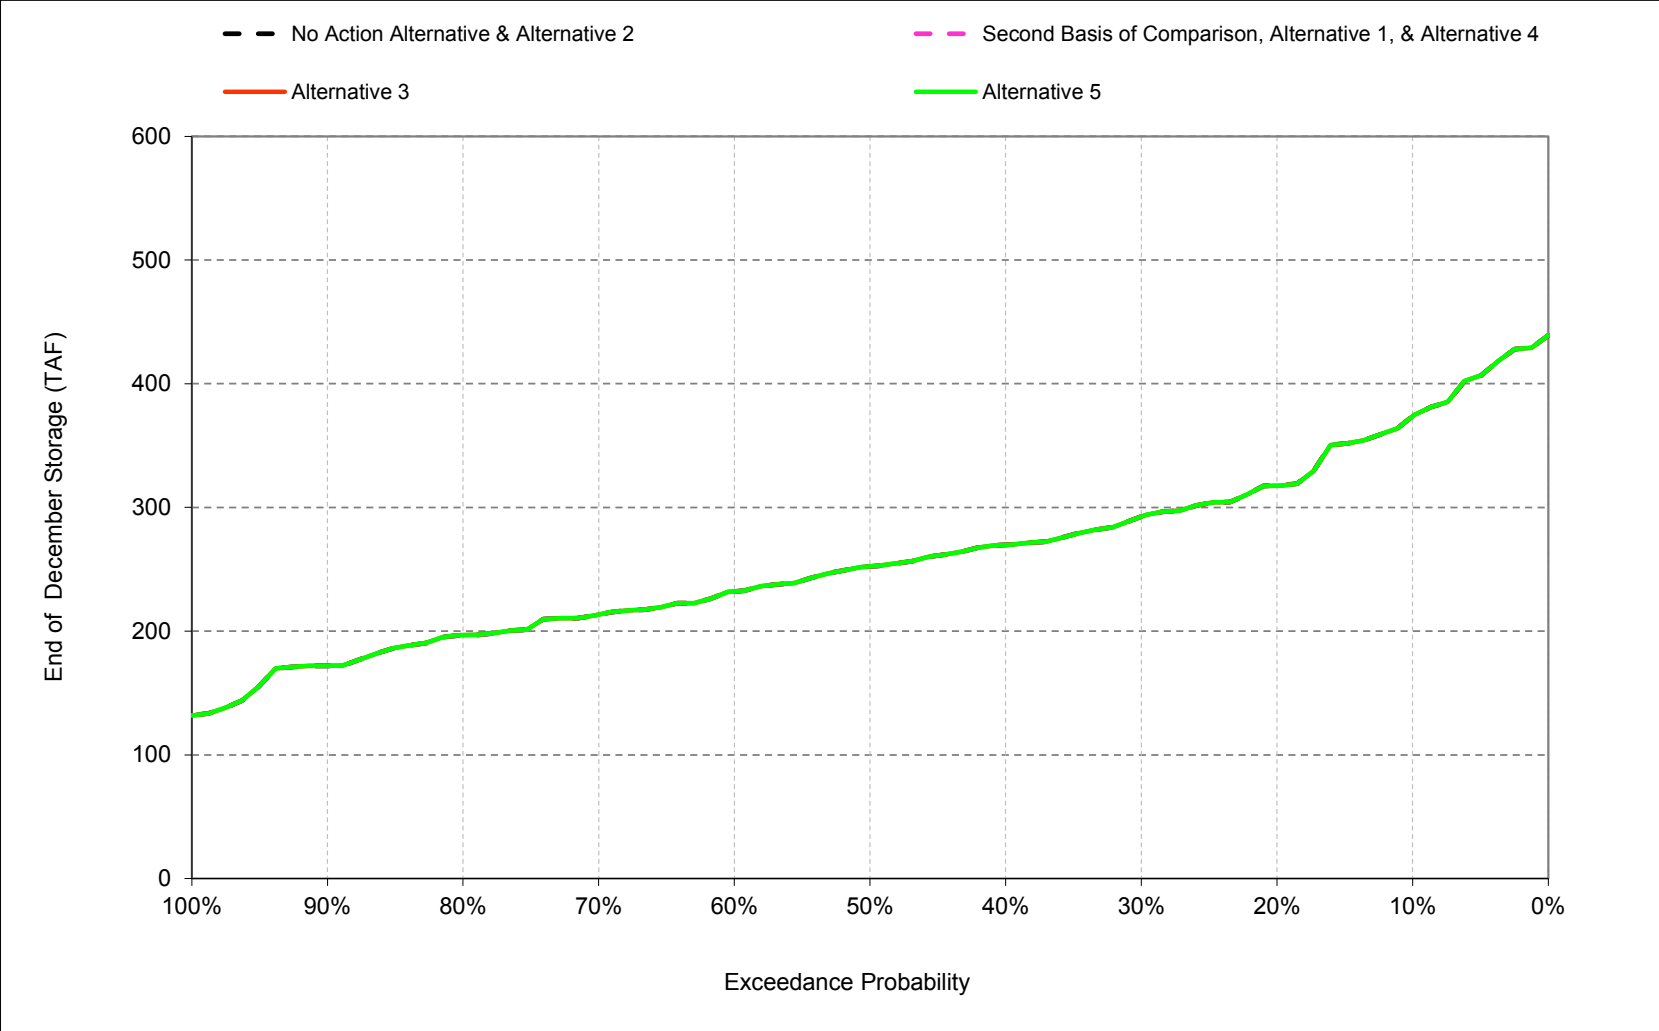


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-7-4. Millerton Lake, End of January Storage

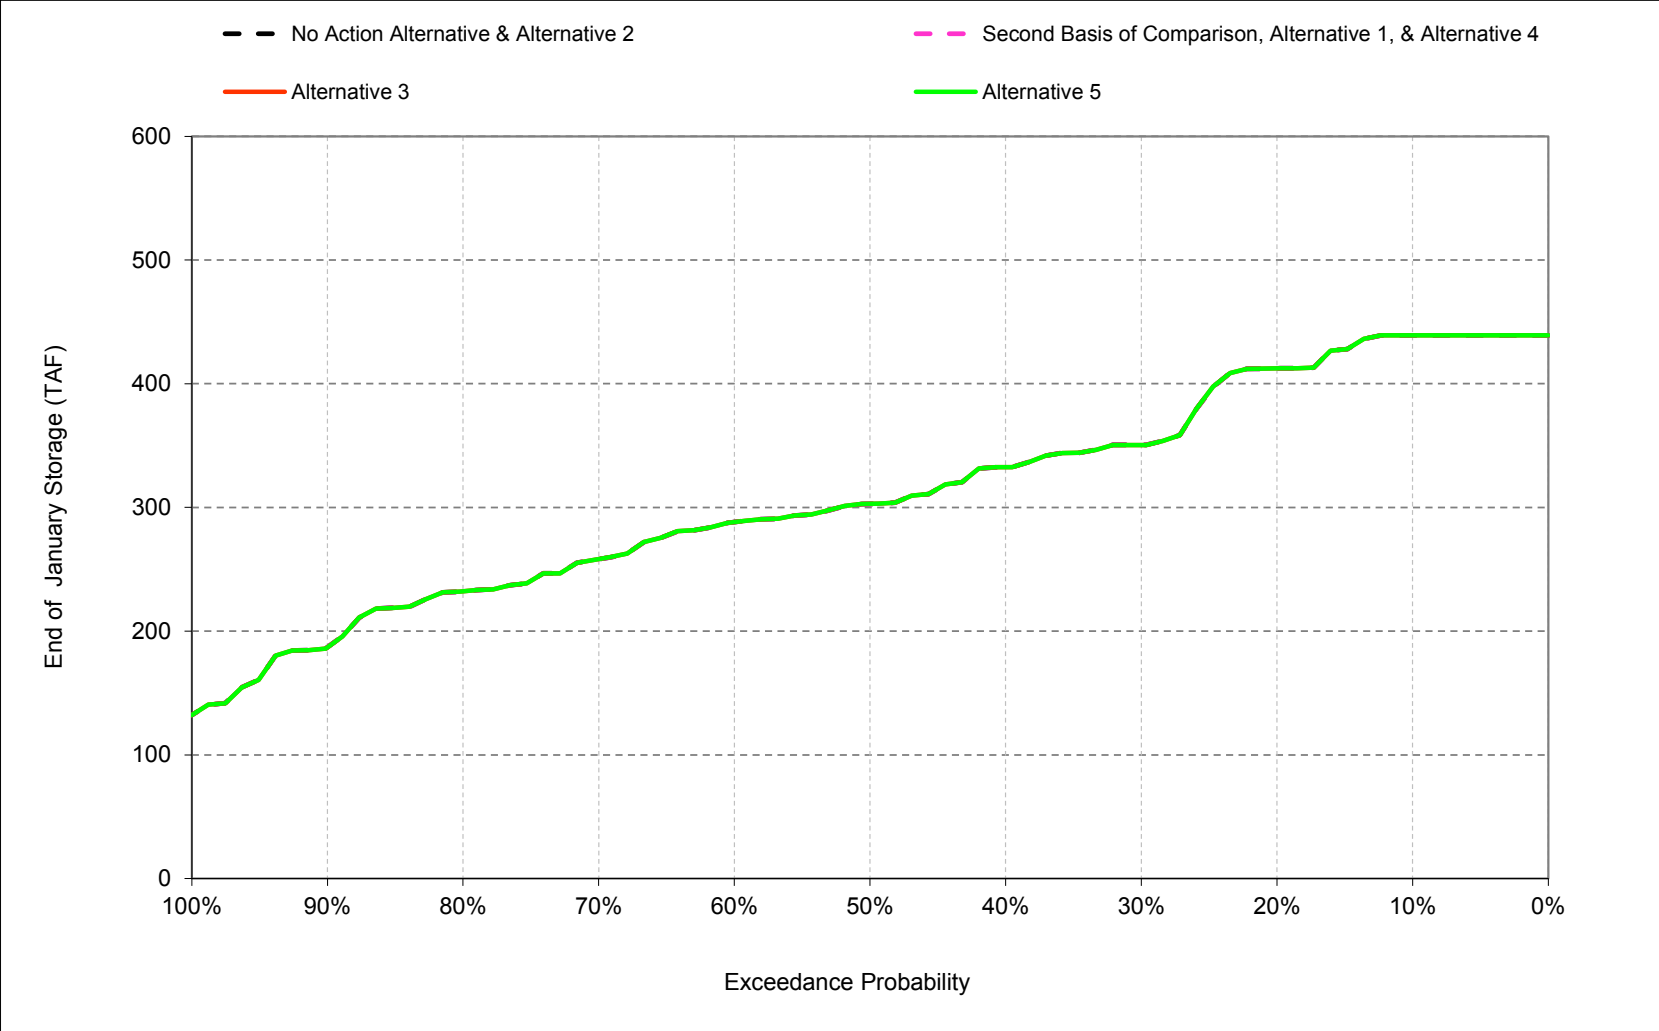


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-7-5. Millerton Lake, End of February Storage

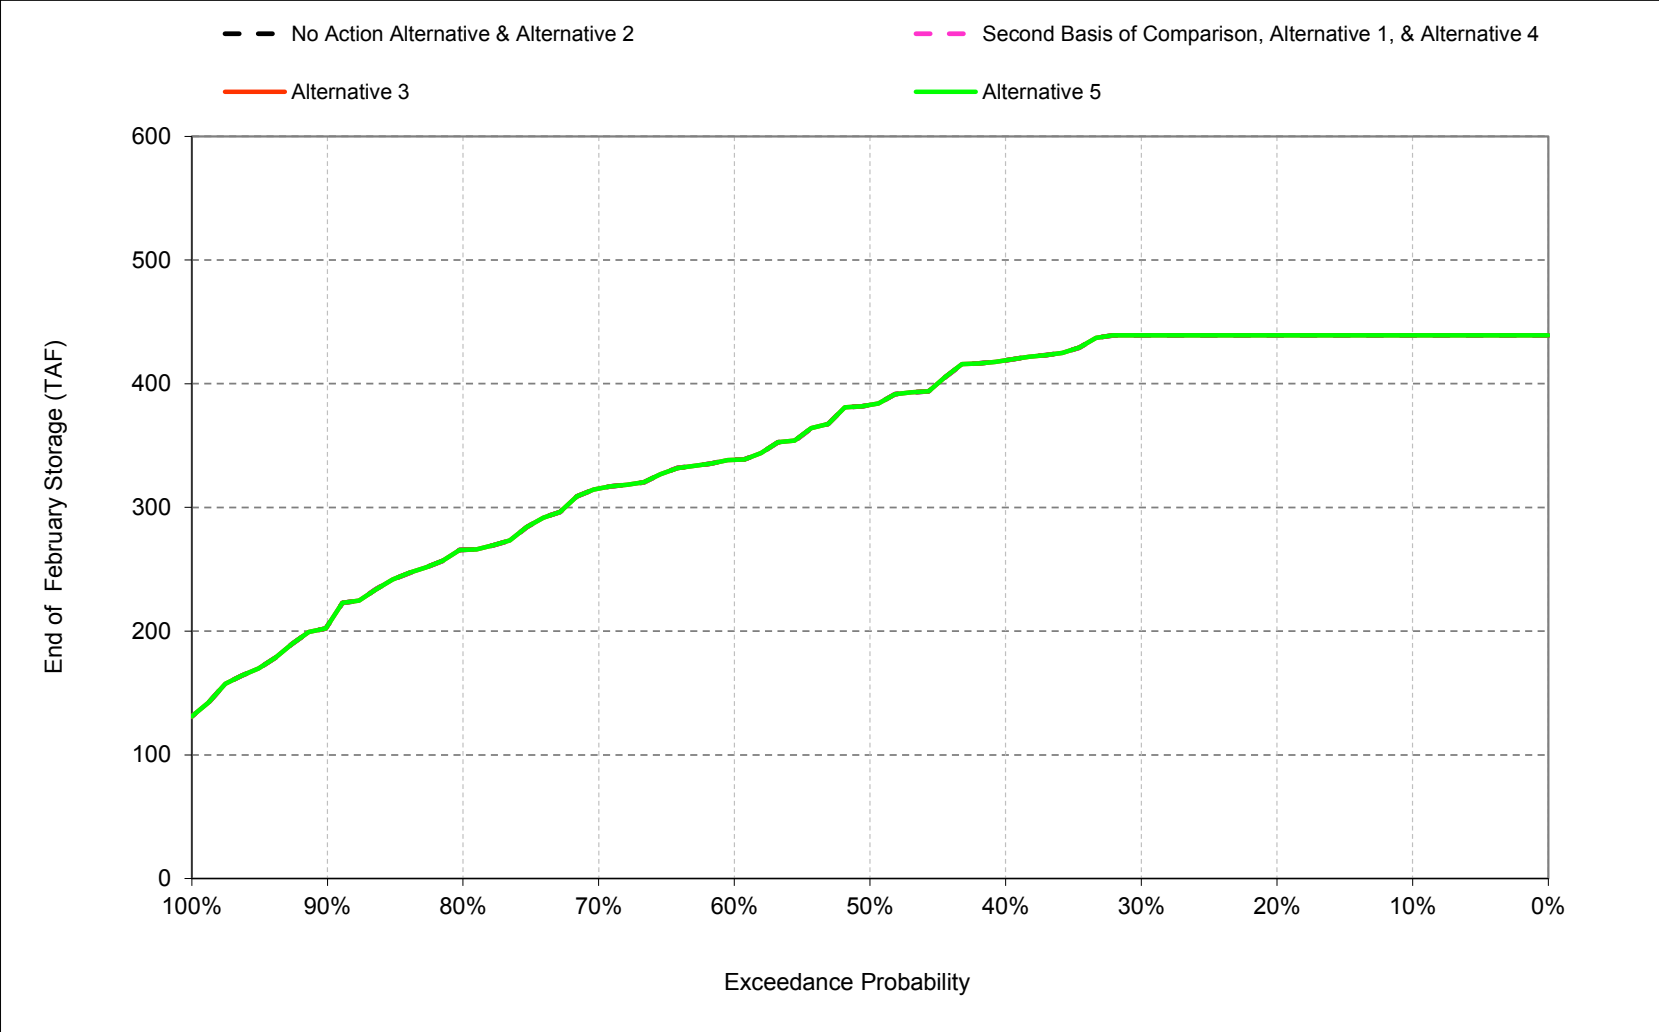


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-7-6. Millerton Lake, End of March Storage

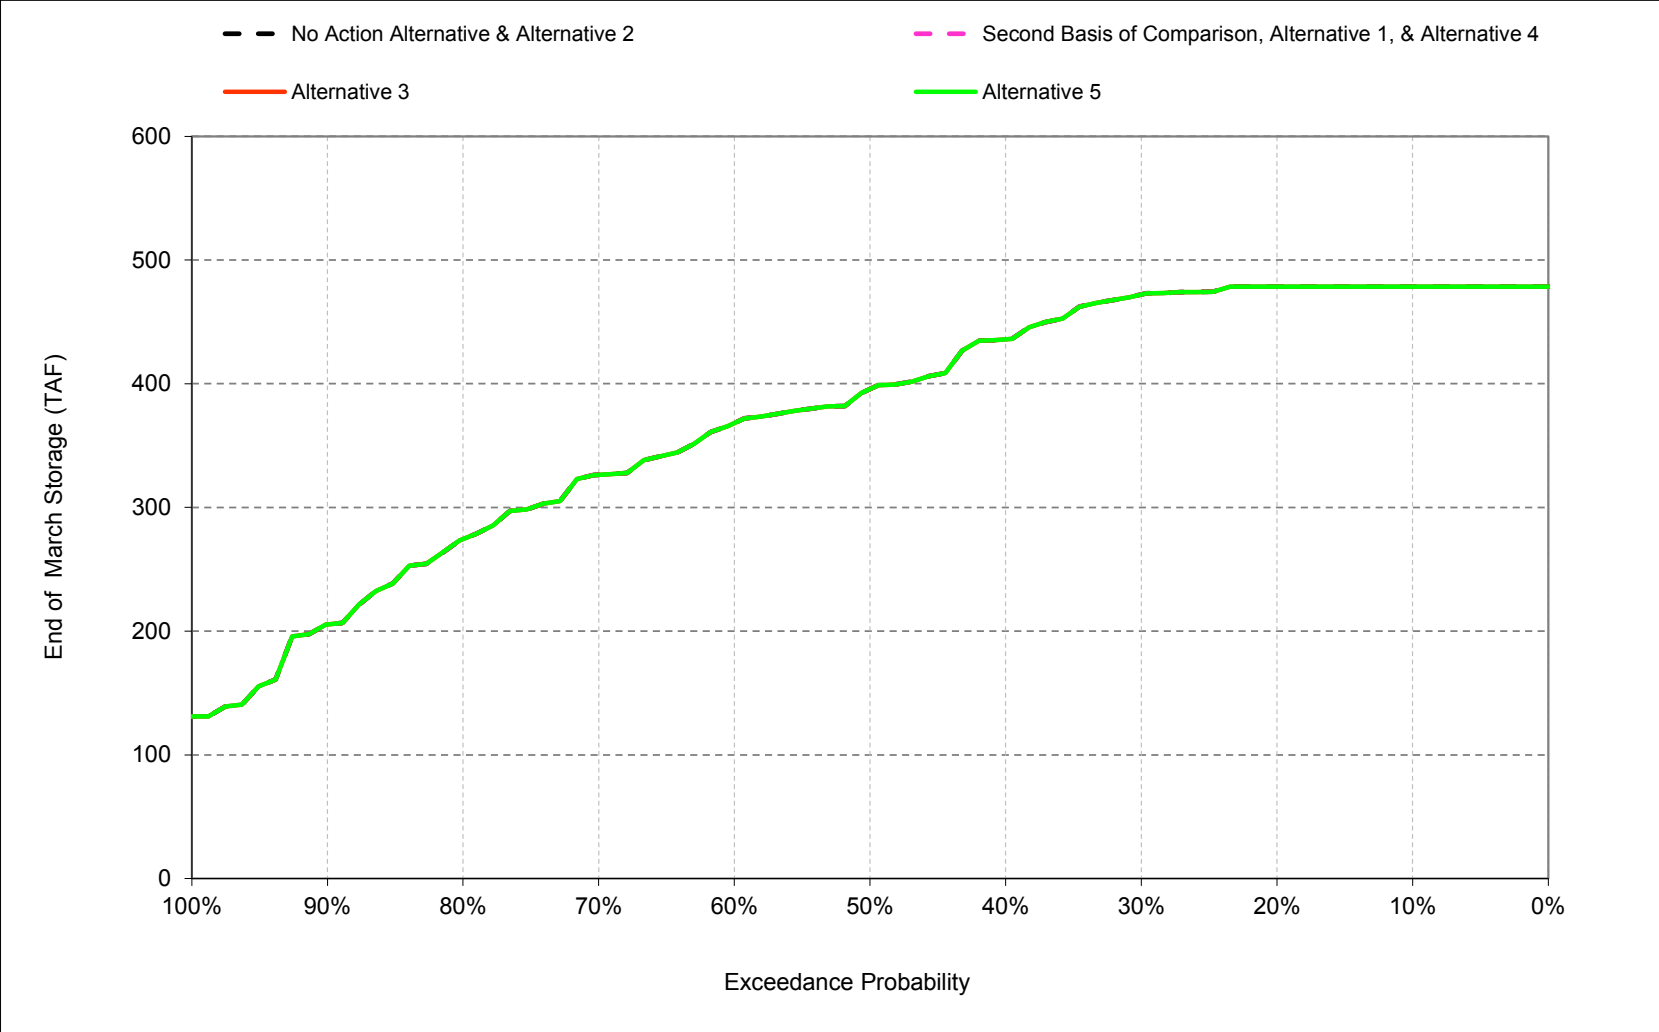


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-7-7. Millerton Lake, End of April Storage

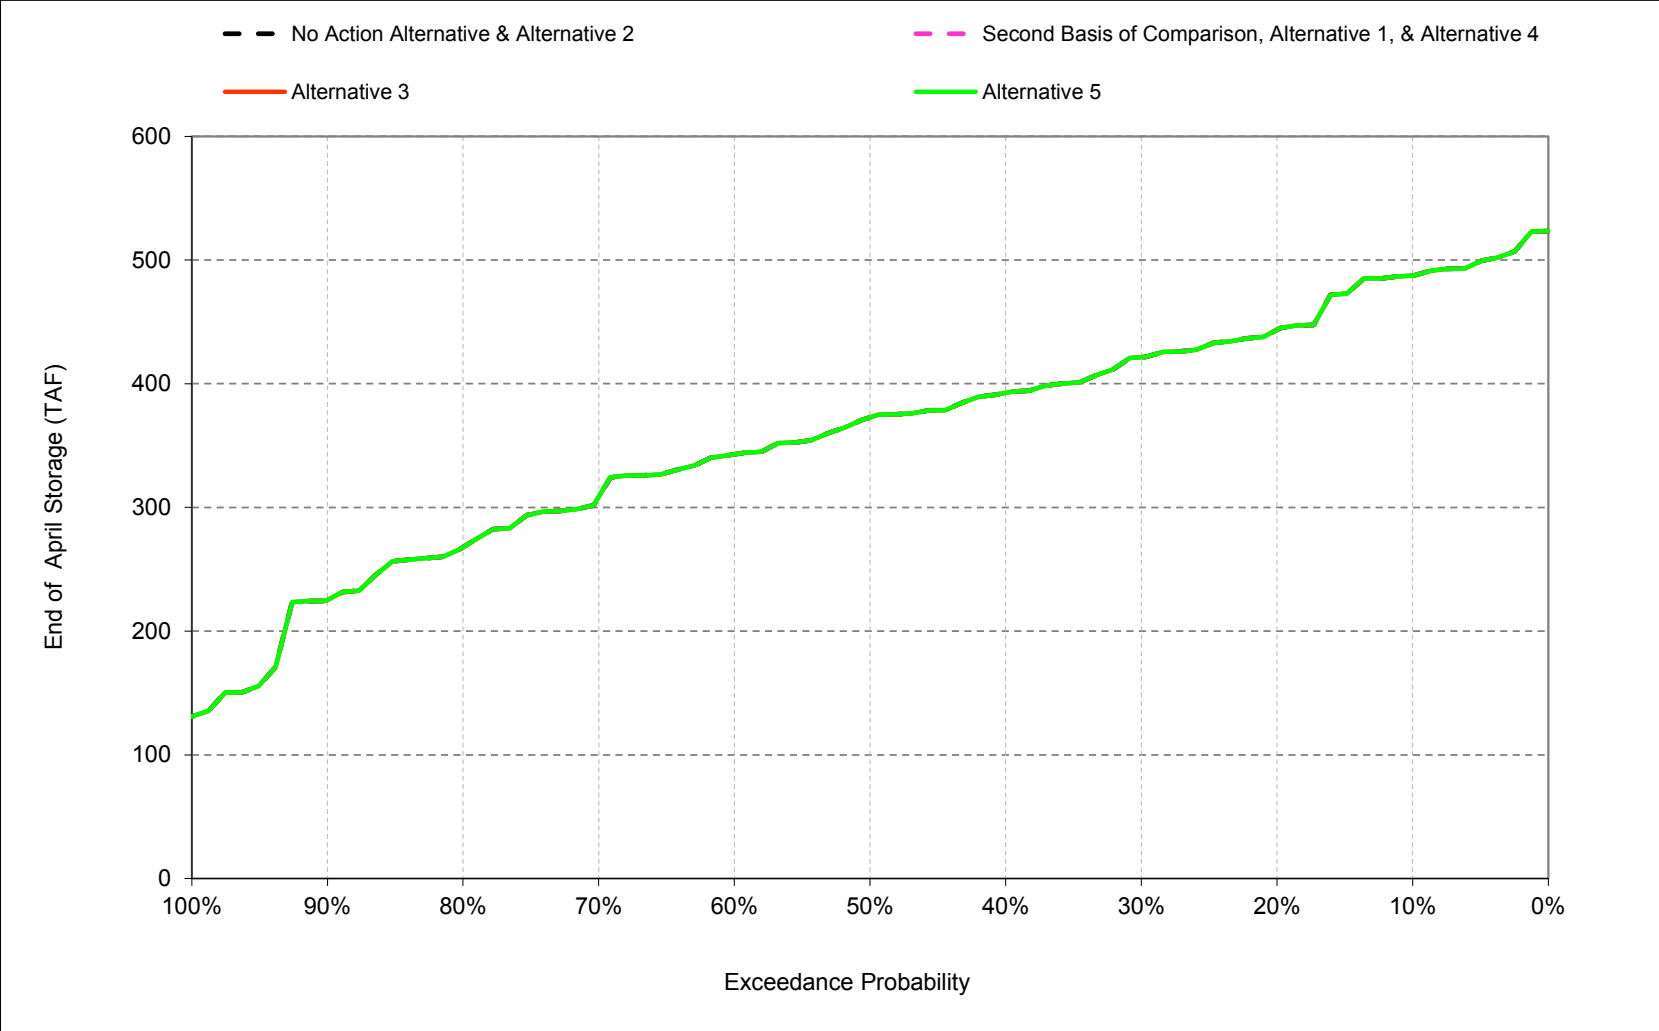


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-7-8. Millerton Lake, End of May Storage

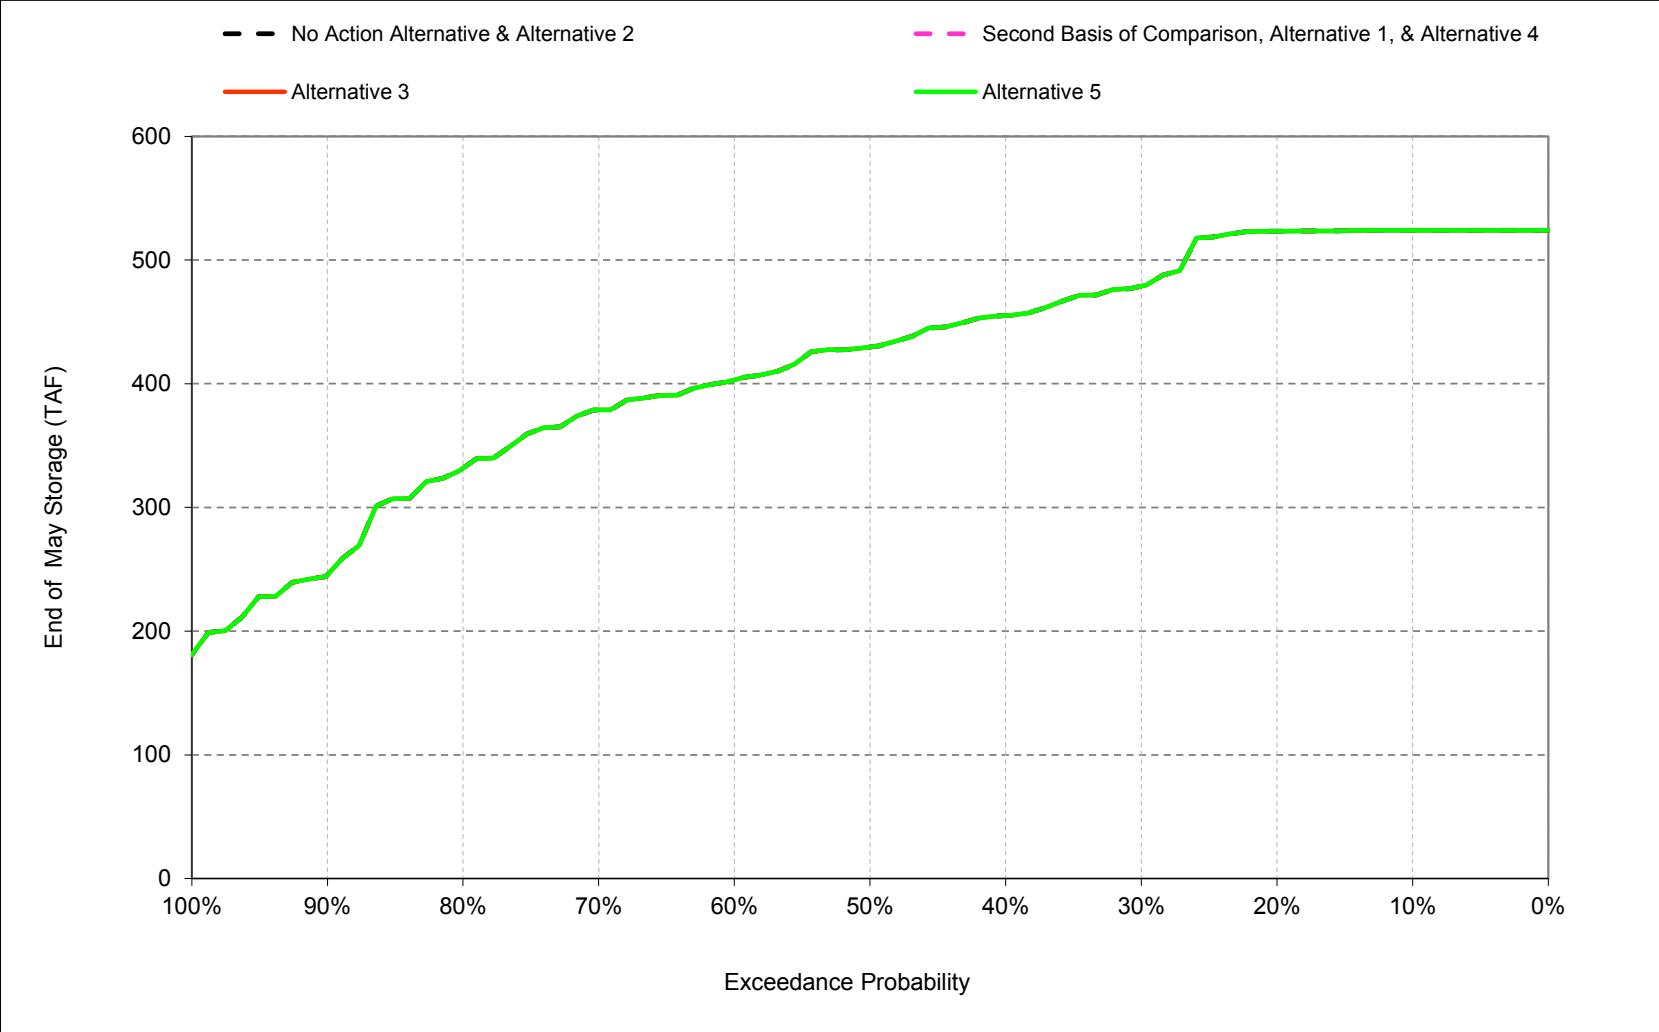


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-7-9. Millerton Lake, End of June Storage

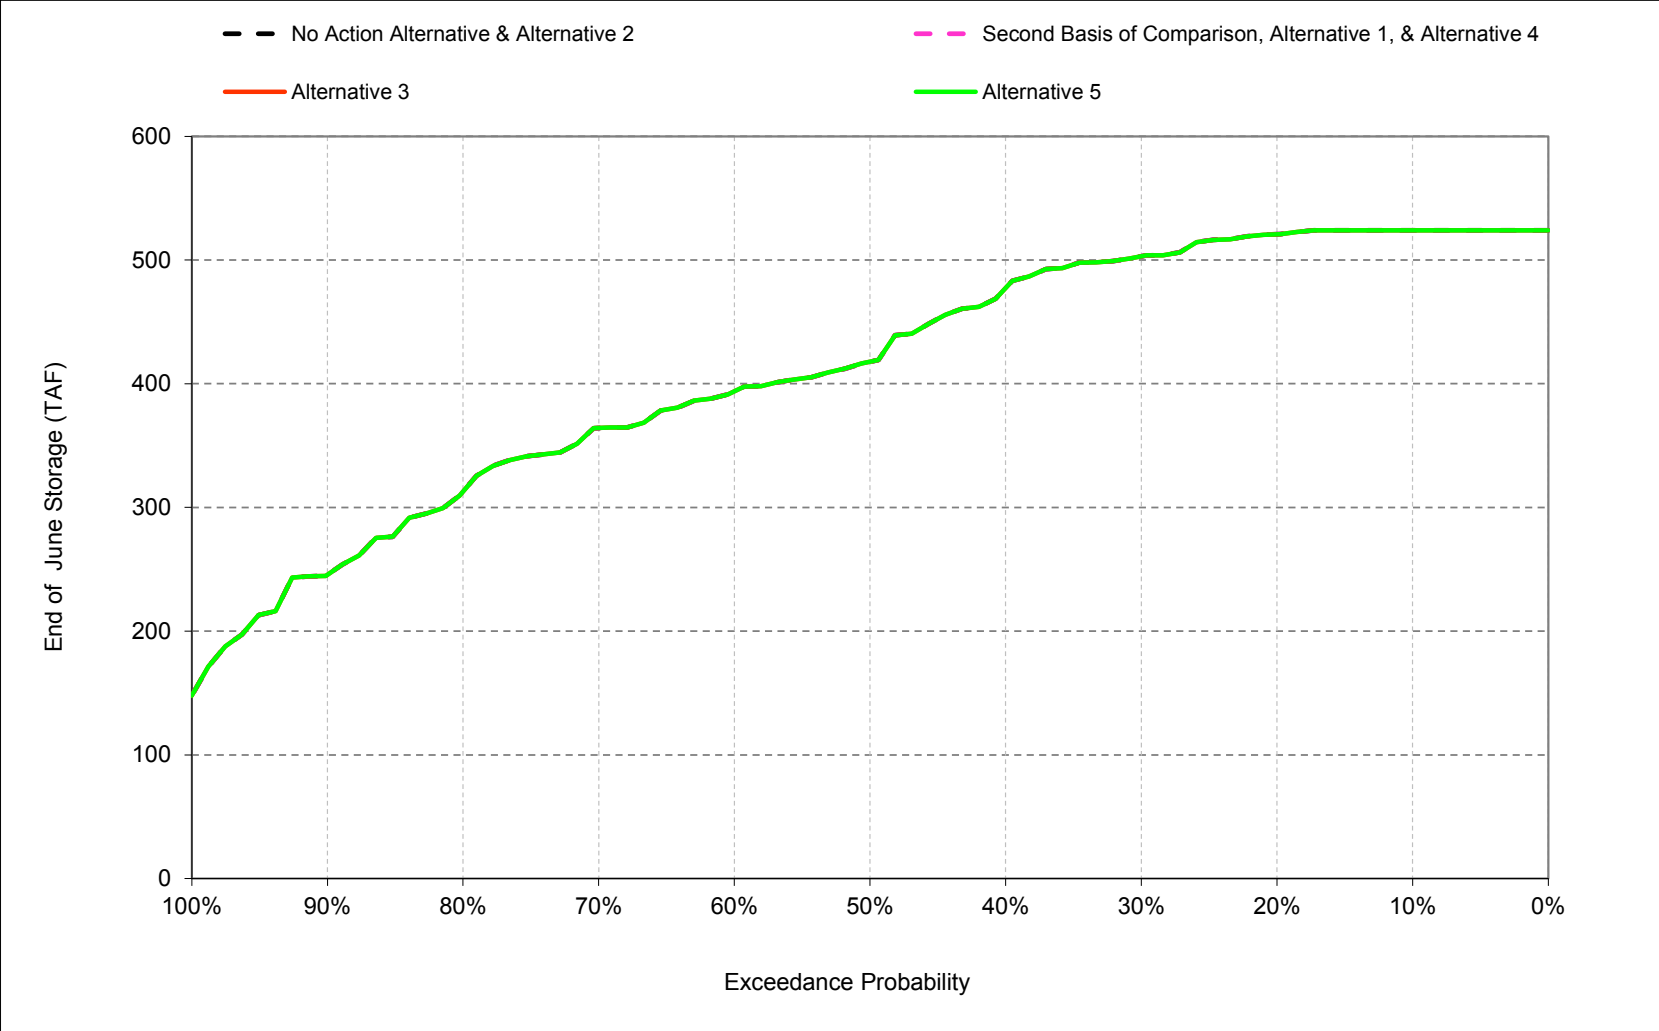


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-7-10. Millerton Lake, End of July Storage

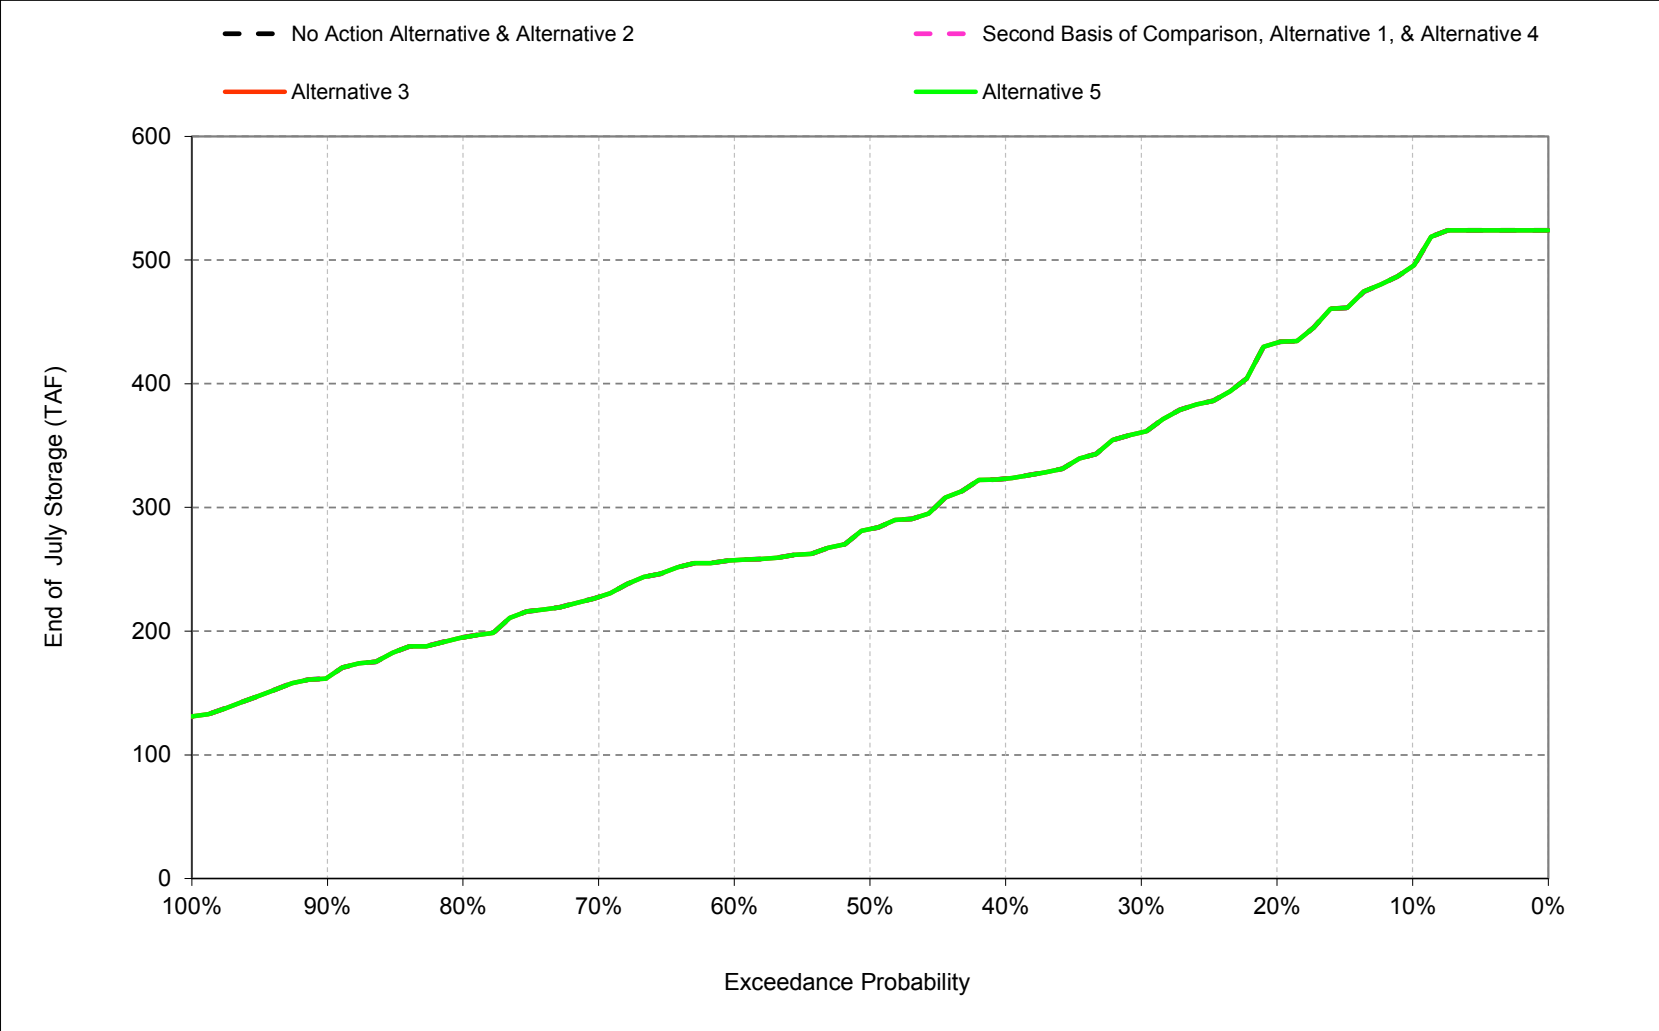


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-7-11. Millerton Lake, End of August Storage

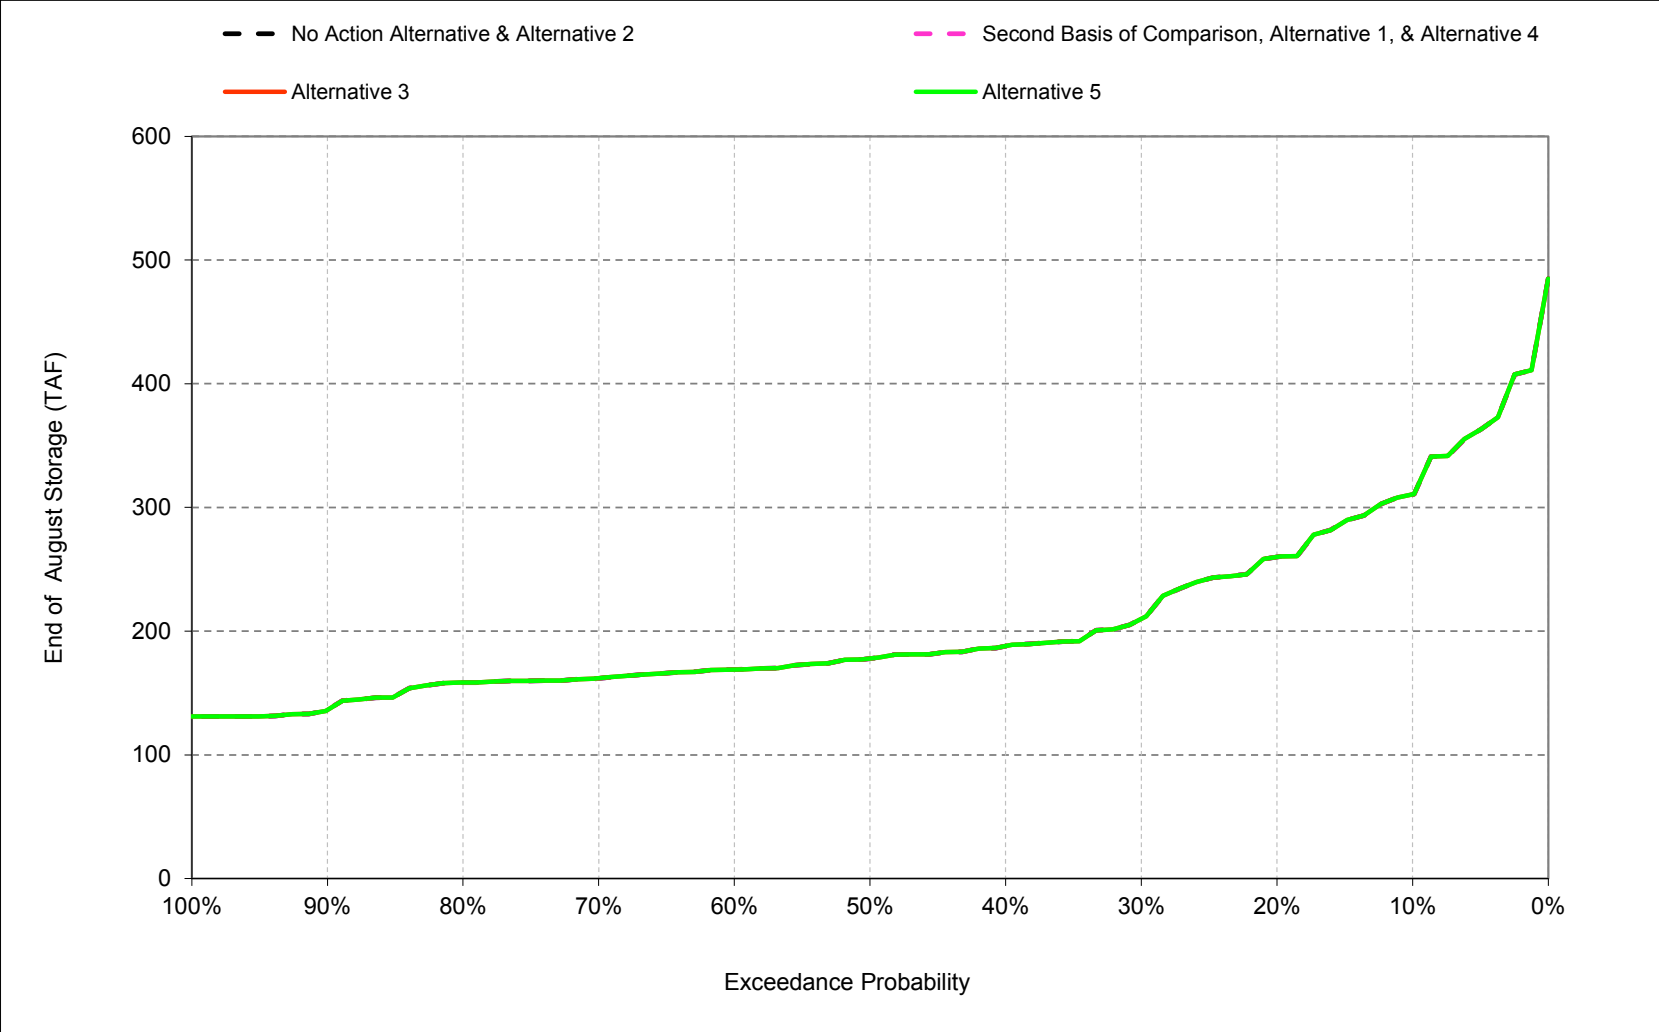

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-7-12. Millerton Lake, End of September Storage

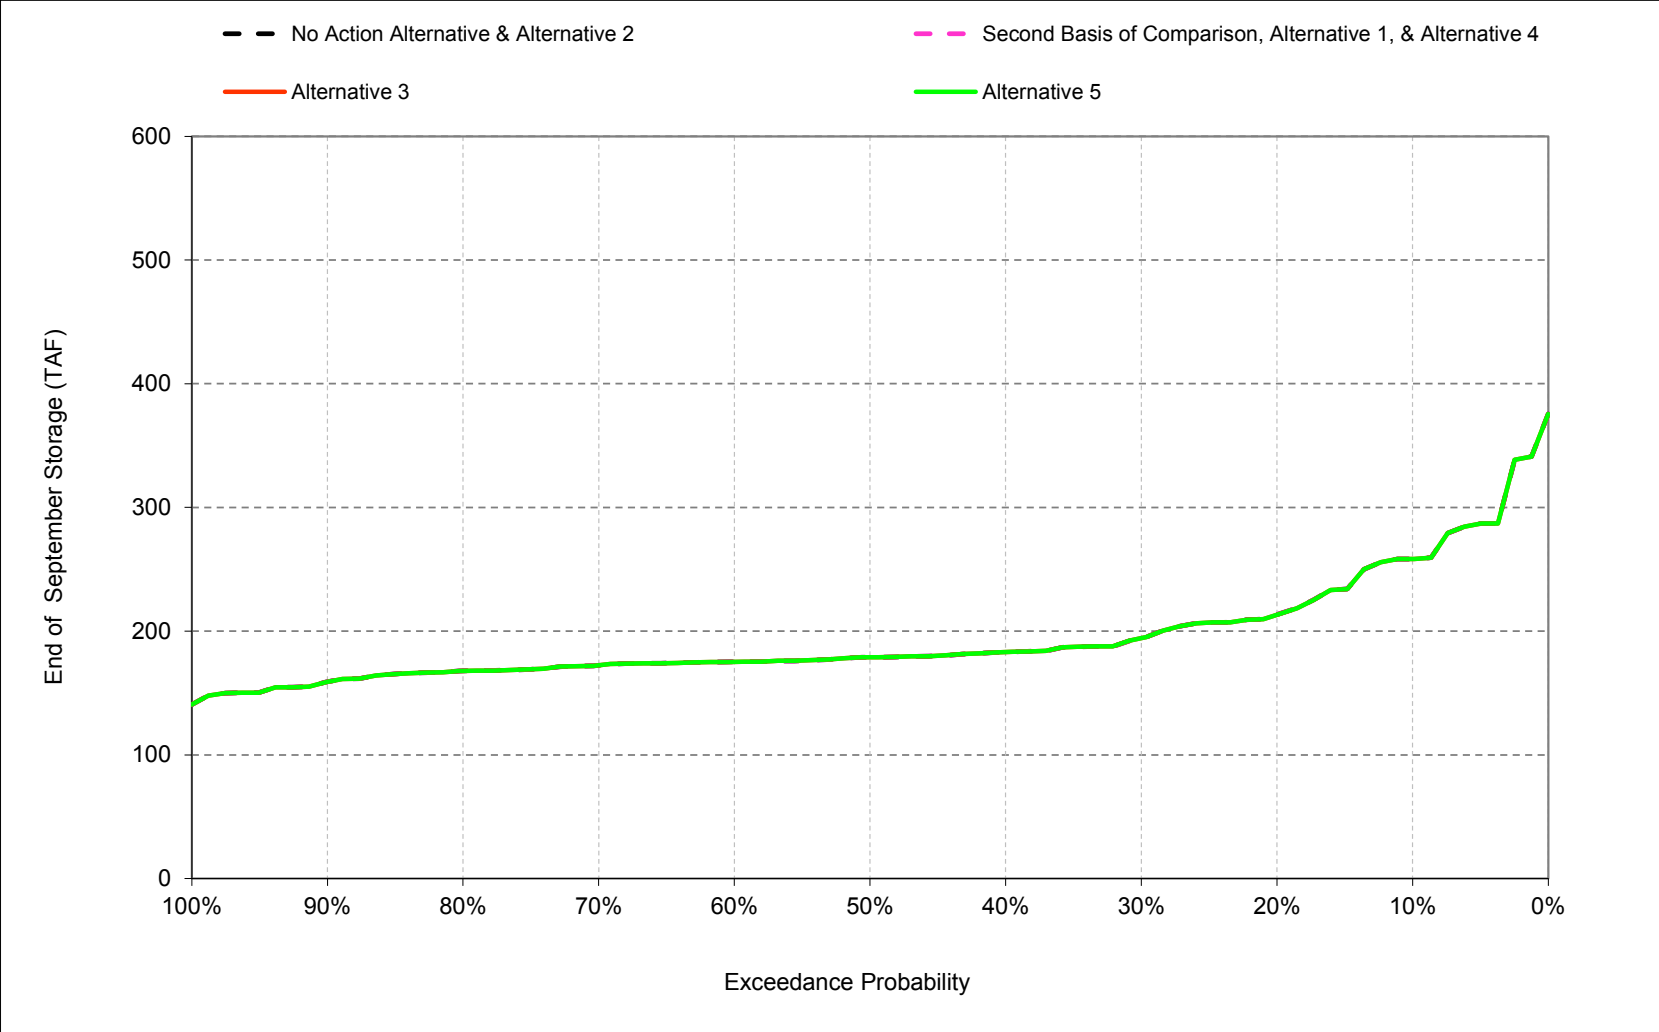

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-7-1. Millerton Lake, End of Month Storage

No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	258	292	374	439	439	479	488	524	524	495	311	258
20%	224	267	318	412	439	479	444	523	521	433	260	213
30%	211	250	293	351	439	472	421	479	503	361	210	194
40%	197	223	270	333	419	436	393	455	477	323	188	183
50%	189	210	252	303	383	396	373	430	418	283	178	179
60%	178	194	232	288	339	368	343	403	394	257	169	175
70%	172	176	213	258	315	326	308	379	364	228	162	172
80%	162	168	197	232	266	274	268	332	313	195	158	168
90%	155	154	172	187	204	205	225	245	246	163	136	159
Long Term												
Full Simulation Period ^b	199	220	261	310	353	372	358	415	411	307	207	195
Water Year Types^c												
Wet (23%)	205	228	306	382	426	448	356	426	509	464	312	256
Above Normal (24%)	202	226	270	340	417	447	403	491	496	355	210	184
Below Normal (10%)	192	227	253	297	354	360	348	401	393	283	185	180
Dry (16%)	213	238	266	302	327	343	386	426	372	231	162	181
Critical (27%)	185	194	212	231	247	260	306	334	278	182	148	168

Alternative 1												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	258	292	374	439	439	479	488	524	524	495	311	258
20%	224	267	318	412	439	479	444	523	521	433	260	213
30%	211	250	293	351	439	472	421	479	503	361	210	194
40%	197	223	270	333	419	436	393	455	477	323	188	183
50%	189	210	252	303	383	396	373	430	418	283	178	179
60%	178	194	232	288	339	368	343	403	394	257	169	175
70%	172	176	213	258	315	326	308	379	364	228	162	172
80%	162	168	197	232	266	274	268	332	313	195	158	168
90%	155	154	172	187	204	205	225	245	246	163	136	159
Long Term												
Full Simulation Period ^b	199	220	261	310	353	372	358	415	411	307	207	195
Water Year Types^c												
Wet (23%)	205	228	306	382	426	448	356	426	509	464	312	256
Above Normal (24%)	202	226	270	340	417	447	403	491	496	355	210	184
Below Normal (10%)	192	227	253	297	354	360	348	401	393	283	185	180
Dry (16%)	213	238	266	302	327	343	386	426	372	231	162	181
Critical (27%)	185	194	212	231	247	260	306	334	278	182	148	168

Alternative 1 minus No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types^c												
Wet (23%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (10%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (27%)	0	0	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-7-2. Millerton Lake, End of Month Storage

No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	258	292	374	439	439	479	488	524	524	495	311	258
20%	224	267	318	412	439	479	444	523	521	433	260	213
30%	211	250	293	351	439	472	421	479	503	361	210	194
40%	197	223	270	333	419	436	393	455	477	323	188	183
50%	189	210	252	303	383	396	373	430	418	283	178	179
60%	178	194	232	288	339	368	343	403	394	257	169	175
70%	172	176	213	258	315	326	308	379	364	228	162	172
80%	162	168	197	232	266	274	268	332	313	195	158	168
90%	155	154	172	187	204	205	225	245	246	163	136	159
Long Term												
Full Simulation Period ^b	199	220	261	310	353	372	358	415	411	307	207	195
Water Year Types^c												
Wet (23%)	205	228	306	382	426	448	356	426	509	464	312	256
Above Normal (24%)	202	226	270	340	417	447	403	491	496	355	210	184
Below Normal (10%)	192	227	253	297	354	360	348	401	393	283	185	180
Dry (16%)	213	238	266	302	327	343	386	426	372	231	162	181
Critical (27%)	185	194	212	231	247	260	306	334	278	182	148	168

Alternative 3												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	258	292	374	439	439	479	488	524	524	495	311	258
20%	224	267	318	412	439	479	444	523	521	433	260	213
30%	211	250	293	351	439	472	421	479	503	361	210	194
40%	197	223	270	333	419	436	393	455	477	323	188	183
50%	189	210	252	303	383	396	373	430	418	283	178	179
60%	178	194	232	288	339	368	343	403	394	257	169	175
70%	172	176	213	258	315	326	308	379	364	228	162	172
80%	162	168	197	232	266	274	268	332	313	195	158	168
90%	155	154	172	187	204	205	225	245	246	163	136	159
Long Term												
Full Simulation Period ^b	199	220	261	310	353	372	358	415	411	307	207	195
Water Year Types^c												
Wet (23%)	205	228	306	382	426	448	356	426	509	464	312	256
Above Normal (24%)	202	226	270	340	417	447	403	491	496	355	210	184
Below Normal (10%)	192	227	253	297	354	360	348	401	393	283	185	180
Dry (16%)	213	238	266	302	327	343	386	426	372	231	162	181
Critical (27%)	185	194	212	231	247	260	306	334	278	182	148	168

Alternative 3 minus No Action Alternative												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types^c												
Wet (23%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (10%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (27%)	0	0	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1/0/1900

No Action Alternative

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	258	292	374	439	439	479	488	524	524	495	311	258
20%	224	267	318	412	439	479	444	523	521	433	260	213
30%	211	250	293	351	439	472	421	479	503	361	210	194
40%	197	223	270	333	419	436	393	455	477	323	188	183
50%	189	210	252	303	383	396	373	430	418	283	178	179
60%	178	194	232	288	339	368	343	403	394	257	169	175
70%	172	176	213	258	315	326	308	379	364	228	162	172
80%	162	168	197	232	266	274	268	332	313	195	158	168
90%	155	154	172	187	204	205	225	245	246	163	136	159
Long Term												
Full Simulation Period ^b	199	220	261	310	353	372	358	415	411	307	207	195
Water Year Types^c												
Wet (23%)	205	228	306	382	426	448	356	426	509	464	312	256
Above Normal (24%)	202	226	270	340	417	447	403	491	496	355	210	184
Below Normal (10%)	192	227	253	297	354	360	348	401	393	283	185	180
Dry (16%)	213	238	266	302	327	343	386	426	372	231	162	181
Critical (27%)	185	194	212	231	247	260	306	334	278	182	148	168

Alternative 5

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	258	292	374	439	439	479	488	524	524	495	311	258
20%	224	267	318	412	439	479	444	523	521	433	260	213
30%	211	250	293	351	439	472	421	479	503	361	210	194
40%	197	223	270	333	419	436	393	455	477	323	188	183
50%	189	210	252	303	383	396	373	430	418	283	178	179
60%	178	194	232	288	339	368	343	403	394	257	169	175
70%	172	176	213	258	315	326	308	379	364	228	162	172
80%	162	168	197	232	266	274	268	332	313	195	158	168
90%	155	154	172	187	204	205	225	245	246	163	136	159
Long Term												
Full Simulation Period ^b	199	220	261	310	353	372	358	415	411	307	207	195
Water Year Types^c												
Wet (23%)	205	228	306	382	426	448	356	426	509	464	312	256
Above Normal (24%)	202	226	270	340	417	447	403	491	496	355	210	184
Below Normal (10%)	192	227	253	297	354	360	348	401	393	283	185	180
Dry (16%)	213	238	266	302	327	343	386	426	372	231	162	181
Critical (27%)	185	194	212	231	247	260	306	334	278	182	148	168

Alternative 5 minus No Action Alternative

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types^c												
Wet (23%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (10%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (27%)	0	0	0	0	0	0	0	0	0	0	0	0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-7-4. Millerton Lake, End of Month Storage

Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	258	292	374	439	439	479	488	524	524	495	311	258
20%	224	267	318	412	439	479	444	523	521	433	260	213
30%	211	250	293	351	439	472	421	479	503	361	210	194
40%	197	223	270	333	419	436	393	455	477	323	188	183
50%	189	210	252	303	383	396	373	430	418	283	178	179
60%	178	194	232	288	339	368	343	403	394	257	169	175
70%	172	176	213	258	315	326	308	379	364	228	162	172
80%	162	168	197	232	266	274	268	332	313	195	158	168
90%	155	154	172	187	204	205	225	245	246	163	136	159
Long Term												
Full Simulation Period ^b	199	220	261	310	353	372	358	415	411	307	207	195
Water Year Types^c												
Wet (23%)	205	228	306	382	426	448	356	426	509	464	312	256
Above Normal (24%)	202	226	270	340	417	447	403	491	496	355	210	184
Below Normal (10%)	192	227	253	297	354	360	348	401	393	283	185	180
Dry (16%)	213	238	266	302	327	343	386	426	372	231	162	181
Critical (27%)	185	194	212	231	247	260	306	334	278	182	148	168

No Action Alternative

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	258	292	374	439	439	479	488	524	524	495	311	258
20%	224	267	318	412	439	479	444	523	521	433	260	213
30%	211	250	293	351	439	472	421	479	503	361	210	194
40%	197	223	270	333	419	436	393	455	477	323	188	183
50%	189	210	252	303	383	396	373	430	418	283	178	179
60%	178	194	232	288	339	368	343	403	394	257	169	175
70%	172	176	213	258	315	326	308	379	364	228	162	172
80%	162	168	197	232	266	274	268	332	313	195	158	168
90%	155	154	172	187	204	205	225	245	246	163	136	159
Long Term												
Full Simulation Period ^b	199	220	261	310	353	372	358	415	411	307	207	195
Water Year Types^c												
Wet (23%)	205	228	306	382	426	448	356	426	509	464	312	256
Above Normal (24%)	202	226	270	340	417	447	403	491	496	355	210	184
Below Normal (10%)	192	227	253	297	354	360	348	401	393	283	185	180
Dry (16%)	213	238	266	302	327	343	386	426	372	231	162	181
Critical (27%)	185	194	212	231	247	260	306	334	278	182	148	168

No Action Alternative minus Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types^c												
Wet (23%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (10%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (27%)	0	0	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-7-5. Millerton Lake, End of Month Storage

Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	258	292	374	439	439	479	488	524	524	495	311	258
20%	224	267	318	412	439	479	444	523	521	433	260	213
30%	211	250	293	351	439	472	421	479	503	361	210	194
40%	197	223	270	333	419	436	393	455	477	323	188	183
50%	189	210	252	303	383	396	373	430	418	283	178	179
60%	178	194	232	288	339	368	343	403	394	257	169	175
70%	172	176	213	258	315	326	308	379	364	228	162	172
80%	162	168	197	232	266	274	268	332	313	195	158	168
90%	155	154	172	187	204	205	225	245	246	163	136	159
Long Term												
Full Simulation Period ^b	199	220	261	310	353	372	358	415	411	307	207	195
Water Year Types^c												
Wet (23%)	205	228	306	382	426	448	356	426	509	464	312	256
Above Normal (24%)	202	226	270	340	417	447	403	491	496	355	210	184
Below Normal (10%)	192	227	253	297	354	360	348	401	393	283	185	180
Dry (16%)	213	238	266	302	327	343	386	426	372	231	162	181
Critical (27%)	185	194	212	231	247	260	306	334	278	182	148	168

Alternative 3

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	258	292	374	439	439	479	488	524	524	495	311	258
20%	224	267	318	412	439	479	444	523	521	433	260	213
30%	211	250	293	351	439	472	421	479	503	361	210	194
40%	197	223	270	333	419	436	393	455	477	323	188	183
50%	189	210	252	303	383	396	373	430	418	283	178	179
60%	178	194	232	288	339	368	343	403	394	257	169	175
70%	172	176	213	258	315	326	308	379	364	228	162	172
80%	162	168	197	232	266	274	268	332	313	195	158	168
90%	155	154	172	187	204	205	225	245	246	163	136	159
Long Term												
Full Simulation Period ^b	199	220	261	310	353	372	358	415	411	307	207	195
Water Year Types^c												
Wet (23%)	205	228	306	382	426	448	356	426	509	464	312	256
Above Normal (24%)	202	226	270	340	417	447	403	491	496	355	210	184
Below Normal (10%)	192	227	253	297	354	360	348	401	393	283	185	180
Dry (16%)	213	238	266	302	327	343	386	426	372	231	162	181
Critical (27%)	185	194	212	231	247	260	306	334	278	182	148	168

Alternative 3 minus Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types^c												
Wet (23%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (10%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (27%)	0	0	0	0	0	0	0	0	0	0	0	0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-7-6. Millerton Lake, End of Month Storage

Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	258	292	374	439	439	479	488	524	524	495	311	258
20%	224	267	318	412	439	479	444	523	521	433	260	213
30%	211	250	293	351	439	472	421	479	503	361	210	194
40%	197	223	270	333	419	436	393	455	477	323	188	183
50%	189	210	252	303	383	396	373	430	418	283	178	179
60%	178	194	232	288	339	368	343	403	394	257	169	175
70%	172	176	213	258	315	326	308	379	364	228	162	172
80%	162	168	197	232	266	274	268	332	313	195	158	168
90%	155	154	172	187	204	205	225	245	246	163	136	159
Long Term												
Full Simulation Period ^b	199	220	261	310	353	372	358	415	411	307	207	195
Water Year Types^c												
Wet (23%)	205	228	306	382	426	448	356	426	509	464	312	256
Above Normal (24%)	202	226	270	340	417	447	403	491	496	355	210	184
Below Normal (10%)	192	227	253	297	354	360	348	401	393	283	185	180
Dry (16%)	213	238	266	302	327	343	386	426	372	231	162	181
Critical (27%)	185	194	212	231	247	260	306	334	278	182	148	168

Alternative 5

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	258	292	374	439	439	479	488	524	524	495	311	258
20%	224	267	318	412	439	479	444	523	521	433	260	213
30%	211	250	293	351	439	472	421	479	503	361	210	194
40%	197	223	270	333	419	436	393	455	477	323	188	183
50%	189	210	252	303	383	396	373	430	418	283	178	179
60%	178	194	232	288	339	368	343	403	394	257	169	175
70%	172	176	213	258	315	326	308	379	364	228	162	172
80%	162	168	197	232	266	274	268	332	313	195	158	168
90%	155	154	172	187	204	205	225	245	246	163	136	159
Long Term												
Full Simulation Period ^b	199	220	261	310	353	372	358	415	411	307	207	195
Water Year Types^c												
Wet (23%)	205	228	306	382	426	448	356	426	509	464	312	256
Above Normal (24%)	202	226	270	340	417	447	403	491	496	355	210	184
Below Normal (10%)	192	227	253	297	354	360	348	401	393	283	185	180
Dry (16%)	213	238	266	302	327	343	386	426	372	231	162	181
Critical (27%)	185	194	212	231	247	260	306	334	278	182	148	168

Alternative 5 minus Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types^c												
Wet (23%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (10%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (27%)	0	0	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 C.8. Trinity Lake Elevation

Figure C-8-1. Trinity Lake, Reservoir Pool Elevation, May

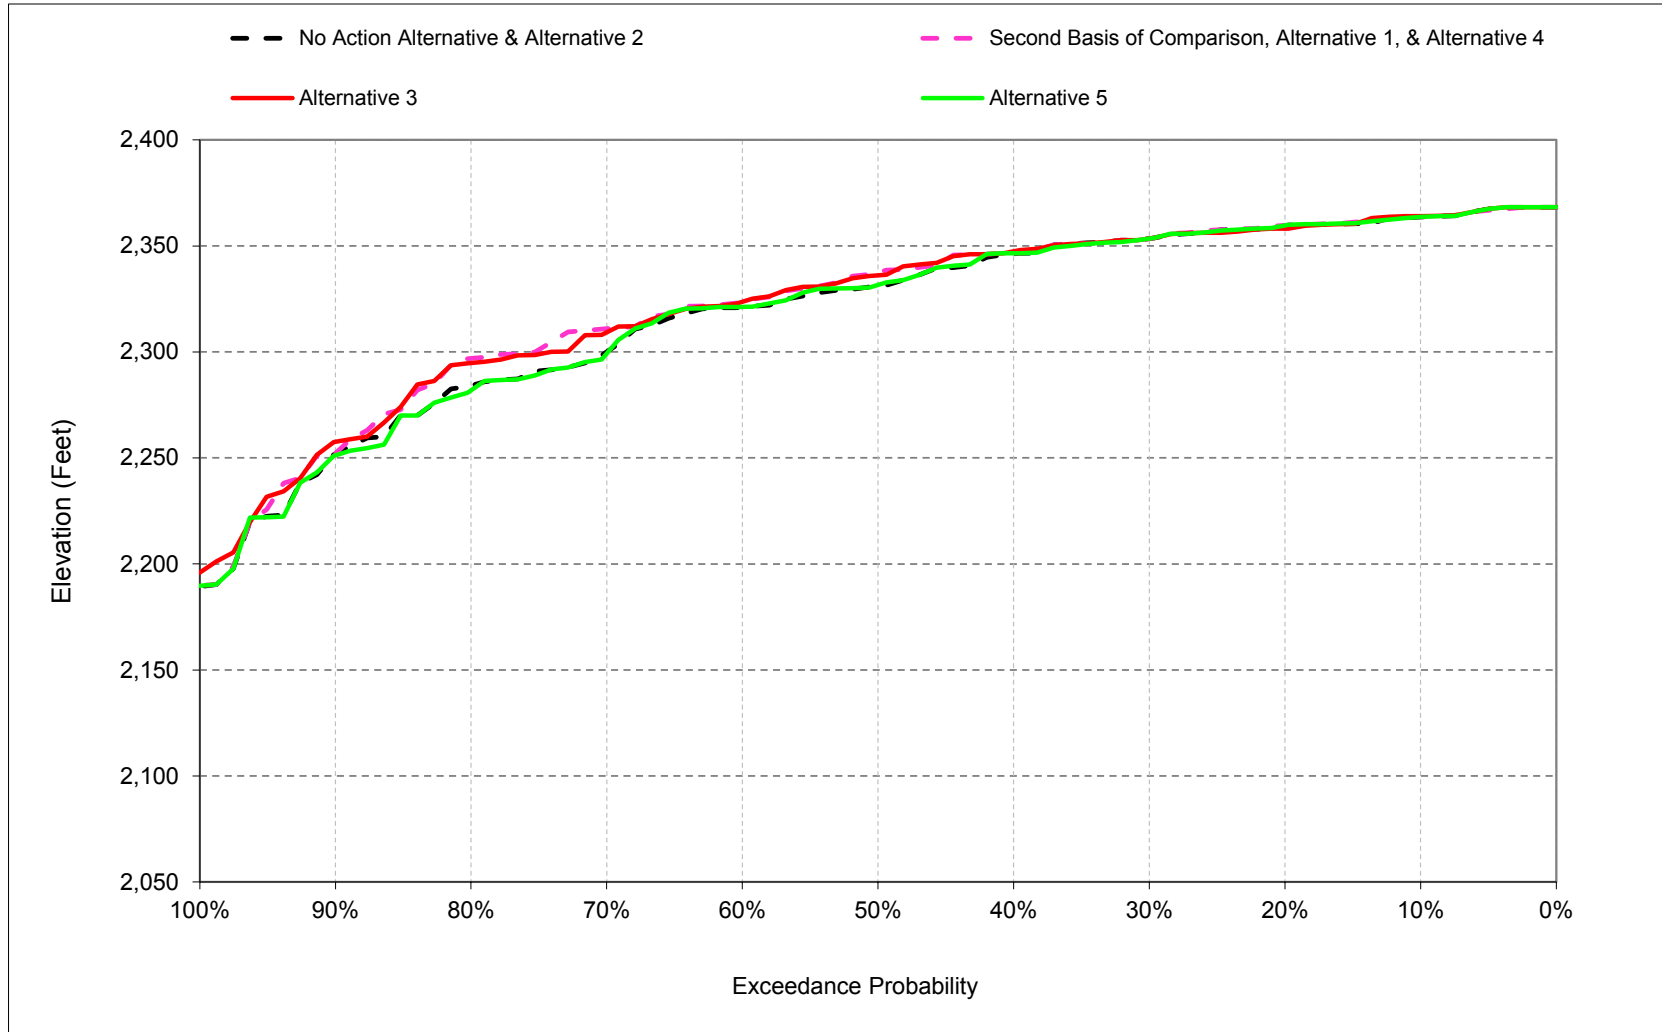

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-8-2. Trinity Lake, Reservoir Pool Elevation, September

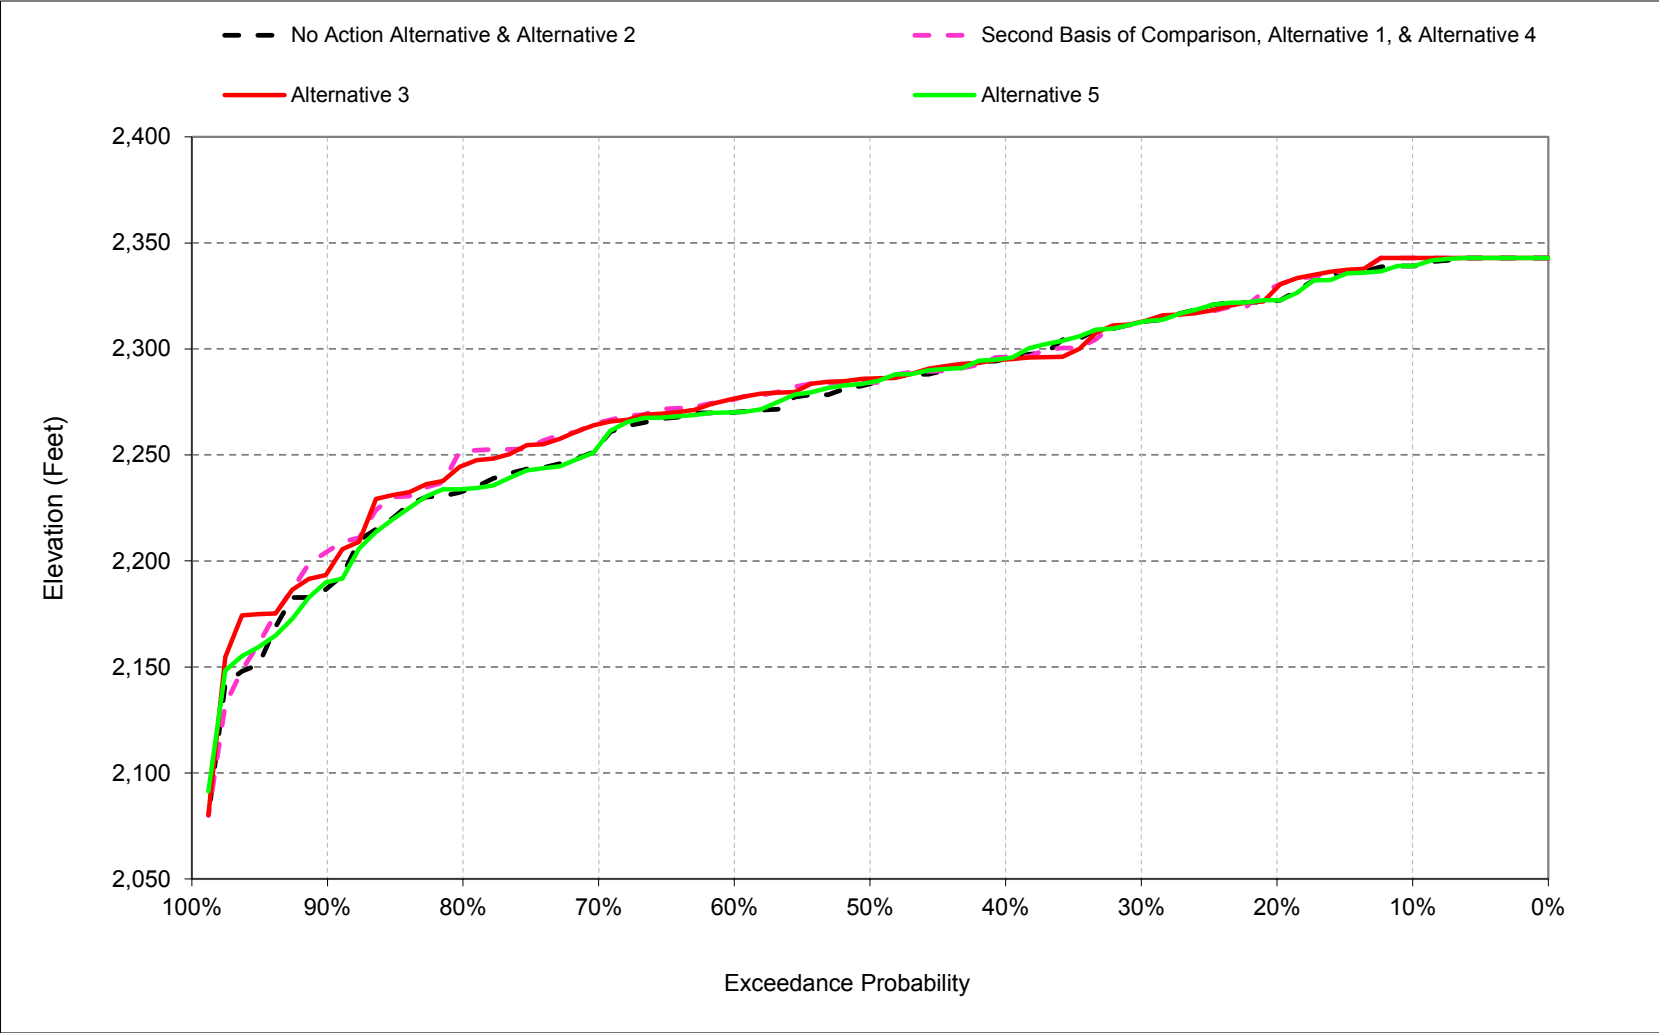

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-8-1. Trinity Lake, End of Month Elevation

No Action Alternative												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,332	2,331	2,332	2,337	2,345	2,350	2,360	2,364	2,361	2,359	2,353	2,339
20%	2,325	2,322	2,328	2,336	2,345	2,350	2,358	2,359	2,356	2,348	2,337	2,324
30%	2,306	2,309	2,318	2,326	2,341	2,349	2,357	2,353	2,348	2,338	2,326	2,314
40%	2,293	2,292	2,307	2,317	2,325	2,343	2,351	2,346	2,338	2,326	2,310	2,297
50%	2,278	2,280	2,291	2,303	2,317	2,325	2,337	2,331	2,320	2,308	2,295	2,286
60%	2,268	2,271	2,280	2,284	2,302	2,317	2,327	2,321	2,313	2,296	2,282	2,271
70%	2,259	2,258	2,266	2,271	2,281	2,291	2,301	2,300	2,294	2,284	2,271	2,262
80%	2,235	2,238	2,241	2,252	2,259	2,270	2,287	2,284	2,278	2,262	2,246	2,236
90%	2,192	2,201	2,205	2,206	2,221	2,246	2,254	2,252	2,245	2,229	2,202	2,195
Long Term												
Full Simulation Period ^b	2,270	2,271	2,278	2,286	2,298	2,310	2,321	2,319	2,314	2,302	2,288	2,276
Water Year Types^c												
Wet (32%)	2,300	2,303	2,313	2,324	2,338	2,347	2,357	2,358	2,355	2,347	2,338	2,327
Above Normal (16%)	2,261	2,264	2,276	2,294	2,314	2,330	2,343	2,341	2,335	2,325	2,313	2,302
Below Normal (13%)	2,289	2,289	2,291	2,299	2,307	2,315	2,327	2,321	2,313	2,299	2,283	2,272
Dry (24%)	2,263	2,265	2,268	2,269	2,279	2,292	2,305	2,301	2,294	2,279	2,264	2,254
Critical (15%)	2,210	2,207	2,210	2,213	2,220	2,235	2,242	2,238	2,235	2,220	2,196	2,182

Alternative 1												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,332	2,332	2,332	2,337	2,345	2,350	2,361	2,364	2,361	2,358	2,353	2,343
20%	2,328	2,331	2,332	2,337	2,345	2,350	2,359	2,360	2,355	2,348	2,338	2,330
30%	2,309	2,310	2,323	2,329	2,343	2,350	2,357	2,353	2,349	2,339	2,327	2,315
40%	2,293	2,298	2,308	2,320	2,333	2,346	2,352	2,347	2,338	2,325	2,309	2,296
50%	2,283	2,283	2,294	2,308	2,318	2,330	2,346	2,338	2,326	2,311	2,296	2,286
60%	2,273	2,276	2,279	2,289	2,306	2,320	2,326	2,324	2,318	2,302	2,288	2,278
70%	2,267	2,266	2,274	2,278	2,291	2,301	2,315	2,311	2,306	2,294	2,279	2,267
80%	2,249	2,250	2,253	2,261	2,269	2,283	2,299	2,297	2,289	2,273	2,261	2,252
90%	2,207	2,208	2,212	2,220	2,232	2,246	2,261	2,252	2,245	2,230	2,215	2,209
Long Term												
Full Simulation Period ^b	2,275	2,277	2,283	2,291	2,303	2,314	2,325	2,322	2,317	2,305	2,291	2,280
Water Year Types^c												
Wet (32%)	2,301	2,305	2,314	2,325	2,339	2,347	2,357	2,358	2,355	2,347	2,338	2,328
Above Normal (16%)	2,270	2,273	2,286	2,303	2,320	2,335	2,347	2,346	2,339	2,329	2,315	2,304
Below Normal (13%)	2,295	2,296	2,298	2,305	2,313	2,320	2,331	2,326	2,318	2,303	2,287	2,274
Dry (24%)	2,266	2,269	2,272	2,274	2,284	2,296	2,309	2,304	2,298	2,284	2,269	2,259
Critical (15%)	2,218	2,216	2,217	2,222	2,229	2,243	2,250	2,246	2,243	2,227	2,204	2,191

Alternative 1 minus No Action Alternative												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	1	0	0	0	0	1	0	0	0	0	4
20%	3	9	5	1	0	0	0	0	-1	0	1	6
30%	3	1	5	4	3	1	0	0	1	1	1	1
40%	1	6	1	3	7	2	1	0	0	-1	0	-1
50%	5	2	2	6	2	4	8	6	6	3	0	0
60%	5	5	-1	5	3	3	-1	3	4	6	6	7
70%	8	8	8	6	10	10	13	11	12	10	7	5
80%	14	12	12	9	10	14	12	13	11	11	15	16
90%	15	8	7	14	11	0	7	0	0	2	13	14
Long Term												
Full Simulation Period ^b	5	5	5	5	4	4	3	4	4	3	3	4
Water Year Types^c												
Wet (32%)	1	2	1	1	1	0	0	0	0	0	0	2
Above Normal (16%)	8	10	10	9	7	5	4	4	4	4	2	2
Below Normal (13%)	6	7	7	6	6	6	4	5	5	4	3	3
Dry (24%)	3	4	4	5	5	4	4	4	5	5	5	5
Critical (15%)	8	8	8	9	8	8	8	8	7	8	8	9

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
^b Based on the 82-year simulation period.
^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-8-2. Trinity Lake, End of Month Elevation

No Action Alternative												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,332	2,331	2,332	2,337	2,345	2,350	2,360	2,364	2,361	2,359	2,353	2,339
20%	2,325	2,322	2,328	2,336	2,345	2,350	2,358	2,359	2,356	2,348	2,337	2,324
30%	2,306	2,309	2,318	2,326	2,341	2,349	2,357	2,353	2,348	2,338	2,326	2,314
40%	2,293	2,292	2,307	2,317	2,325	2,343	2,351	2,346	2,338	2,326	2,310	2,297
50%	2,278	2,280	2,291	2,303	2,317	2,325	2,337	2,331	2,320	2,308	2,295	2,286
60%	2,268	2,271	2,280	2,284	2,302	2,317	2,327	2,321	2,313	2,296	2,282	2,271
70%	2,259	2,258	2,266	2,271	2,281	2,291	2,301	2,300	2,294	2,284	2,271	2,262
80%	2,235	2,238	2,241	2,252	2,259	2,270	2,287	2,284	2,278	2,262	2,246	2,236
90%	2,192	2,201	2,205	2,206	2,221	2,246	2,254	2,252	2,245	2,229	2,202	2,195
Long Term												
Full Simulation Period ^b	2,270	2,271	2,278	2,286	2,298	2,310	2,321	2,319	2,314	2,302	2,288	2,276
Water Year Types^c												
Wet (32%)	2,300	2,303	2,313	2,324	2,338	2,347	2,357	2,358	2,355	2,347	2,338	2,327
Above Normal (16%)	2,261	2,264	2,276	2,294	2,314	2,330	2,343	2,341	2,335	2,325	2,313	2,302
Below Normal (13%)	2,289	2,289	2,291	2,299	2,307	2,315	2,327	2,321	2,313	2,299	2,283	2,272
Dry (24%)	2,263	2,265	2,268	2,269	2,279	2,292	2,305	2,301	2,294	2,279	2,264	2,254
Critical (15%)	2,210	2,207	2,210	2,213	2,220	2,235	2,242	2,238	2,235	2,220	2,196	2,182

Alternative 3												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,332	2,332	2,332	2,337	2,345	2,350	2,361	2,364	2,361	2,356	2,350	2,343
20%	2,329	2,331	2,332	2,337	2,345	2,350	2,359	2,358	2,356	2,348	2,337	2,330
30%	2,310	2,312	2,321	2,328	2,342	2,349	2,357	2,353	2,348	2,339	2,327	2,315
40%	2,291	2,294	2,309	2,317	2,333	2,345	2,351	2,347	2,340	2,324	2,309	2,296
50%	2,282	2,282	2,296	2,310	2,320	2,330	2,344	2,336	2,327	2,311	2,296	2,286
60%	2,273	2,276	2,279	2,287	2,306	2,321	2,327	2,324	2,317	2,302	2,289	2,278
70%	2,266	2,266	2,275	2,276	2,289	2,300	2,313	2,309	2,305	2,293	2,278	2,266
80%	2,245	2,250	2,251	2,260	2,272	2,281	2,297	2,295	2,288	2,272	2,257	2,248
90%	2,206	2,206	2,205	2,213	2,229	2,246	2,262	2,258	2,251	2,236	2,215	2,206
Long Term												
Full Simulation Period ^b	2,275	2,277	2,283	2,291	2,303	2,314	2,324	2,322	2,317	2,305	2,291	2,281
Water Year Types^c												
Wet (32%)	2,301	2,305	2,314	2,325	2,339	2,347	2,357	2,358	2,355	2,347	2,338	2,328
Above Normal (16%)	2,268	2,271	2,284	2,301	2,319	2,334	2,347	2,345	2,339	2,328	2,315	2,304
Below Normal (13%)	2,293	2,295	2,297	2,304	2,312	2,319	2,330	2,325	2,317	2,302	2,286	2,274
Dry (24%)	2,265	2,268	2,271	2,273	2,283	2,296	2,309	2,305	2,299	2,284	2,269	2,260
Critical (15%)	2,226	2,220	2,222	2,225	2,231	2,244	2,252	2,248	2,244	2,229	2,204	2,193

Alternative 3 minus No Action Alternative													
Statistic	End of Month Elevation (Feet)												
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	0	1	0	0	0	0	1	0	0	-3	-2	4	
20%	4	8	4	1	0	0	0	-1	0	0	0	6	
30%	3	3	3	2	1	-1	0	0	0	1	2	2	
40%	-2	3	1	0	8	1	-1	1	2	-1	0	-1	
50%	4	2	4	7	3	5	7	5	6	3	0	0	
60%	5	5	0	4	3	4	0	2	4	6	6	7	
70%	7	8	8	5	8	9	12	9	11	9	7	4	
80%	10	12	10	8	13	11	10	11	9	10	11	12	
90%	14	6	0	7	8	0	9	6	6	7	13	11	
Long Term													
Full Simulation Period ^b	5	5	5	5	4	4	3	4	4	3	3	4	
Water Year Types^c													
Wet (32%)	1	2	1	1	1	0	0	0	0	0	0	2	
Above Normal (16%)	7	8	8	7	5	4	4	4	4	3	2	2	
Below Normal (13%)	4	5	6	5	5	5	3	4	4	3	3	2	
Dry (24%)	3	3	3	4	4	4	4	4	5	5	5	6	
Critical (15%)	16	13	13	12	11	10	9	9	9	9	8	11	

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-8-3. Trinity Lake, End of Month Elevation

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance ^a												
10%	2,332	2,331	2,332	2,337	2,345	2,350	2,360	2,364	2,361	2,359	2,353	2,339
20%	2,325	2,322	2,328	2,336	2,345	2,350	2,358	2,359	2,356	2,348	2,337	2,324
30%	2,306	2,309	2,318	2,326	2,341	2,349	2,357	2,353	2,348	2,338	2,326	2,314
40%	2,293	2,292	2,307	2,317	2,325	2,343	2,351	2,346	2,338	2,326	2,310	2,297
50%	2,278	2,280	2,291	2,303	2,317	2,325	2,337	2,331	2,320	2,308	2,295	2,286
60%	2,268	2,271	2,280	2,284	2,302	2,317	2,327	2,321	2,313	2,296	2,282	2,271
70%	2,259	2,258	2,266	2,271	2,281	2,291	2,301	2,300	2,294	2,284	2,271	2,262
80%	2,235	2,238	2,241	2,252	2,259	2,270	2,287	2,284	2,278	2,262	2,246	2,236
90%	2,192	2,201	2,205	2,206	2,221	2,246	2,254	2,252	2,245	2,229	2,202	2,195
Long Term												
Full Simulation Period ^b	2,270	2,271	2,278	2,286	2,298	2,310	2,321	2,319	2,314	2,302	2,288	2,276
Water Year Types ^c												
Wet (32%)	2,300	2,303	2,313	2,324	2,338	2,347	2,357	2,358	2,355	2,347	2,338	2,327
Above Normal (16%)	2,261	2,264	2,276	2,294	2,314	2,330	2,343	2,341	2,335	2,325	2,313	2,302
Below Normal (13%)	2,289	2,289	2,291	2,299	2,307	2,315	2,327	2,321	2,313	2,299	2,283	2,272
Dry (24%)	2,263	2,265	2,268	2,269	2,279	2,292	2,305	2,301	2,294	2,279	2,264	2,254
Critical (15%)	2,210	2,207	2,210	2,213	2,220	2,235	2,242	2,238	2,235	2,220	2,196	2,182

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 5												
Probability of Exceedance ^a												
10%	2,332	2,330	2,332	2,337	2,345	2,350	2,360	2,364	2,361	2,359	2,353	2,339
20%	2,325	2,322	2,328	2,336	2,345	2,350	2,358	2,360	2,356	2,348	2,336	2,323
30%	2,306	2,309	2,319	2,326	2,341	2,349	2,357	2,353	2,348	2,338	2,326	2,314
40%	2,296	2,292	2,308	2,318	2,325	2,344	2,352	2,347	2,338	2,326	2,311	2,299
50%	2,279	2,281	2,292	2,304	2,317	2,326	2,336	2,332	2,322	2,308	2,296	2,286
60%	2,269	2,273	2,281	2,284	2,302	2,317	2,328	2,321	2,314	2,301	2,283	2,271
70%	2,261	2,259	2,266	2,271	2,281	2,292	2,301	2,299	2,293	2,283	2,270	2,263
80%	2,235	2,238	2,241	2,252	2,259	2,270	2,288	2,282	2,277	2,262	2,248	2,235
90%	2,190	2,200	2,201	2,206	2,221	2,245	2,253	2,251	2,246	2,232	2,203	2,193
Long Term												
Full Simulation Period ^b	2,270	2,271	2,278	2,286	2,299	2,310	2,321	2,319	2,314	2,302	2,289	2,277
Water Year Types ^c												
Wet (32%)	2,300	2,303	2,313	2,325	2,338	2,347	2,357	2,358	2,355	2,347	2,338	2,326
Above Normal (16%)	2,259	2,262	2,276	2,294	2,314	2,330	2,343	2,342	2,335	2,326	2,313	2,303
Below Normal (13%)	2,289	2,290	2,292	2,299	2,308	2,315	2,326	2,321	2,313	2,299	2,284	2,272
Dry (24%)	2,263	2,265	2,268	2,269	2,279	2,292	2,305	2,301	2,294	2,279	2,265	2,254
Critical (15%)	2,209	2,206	2,209	2,212	2,220	2,234	2,241	2,237	2,235	2,221	2,199	2,183

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 5 minus No Action Alternative												
Probability of Exceedance ^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	1	0	0	0	0	0	0	0	-1	-1
30%	0	0	1	0	0	0	0	0	0	0	0	0
40%	4	0	0	1	0	1	1	0	0	0	1	2
50%	1	1	1	1	1	0	-1	0	2	0	1	1
60%	1	2	1	0	0	0	0	0	0	5	1	0
70%	2	2	-1	-1	0	1	0	-1	0	-1	-1	1
80%	0	-1	0	0	0	0	1	-2	-1	1	2	-1
90%	-2	0	-4	0	0	-1	-1	-1	1	3	1	-2
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	1	1	0
Water Year Types ^c												
Wet (32%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (16%)	-2	-2	0	0	0	0	0	0	0	0	1	1
Below Normal (13%)	1	1	1	1	1	0	0	0	0	0	1	0
Dry (24%)	1	0	0	0	0	0	0	0	0	0	1	1
Critical (15%)	0	-1	-1	-1	-1	-1	-1	-1	-1	2	3	1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-8-4. Trinity Lake, End of Month Elevation

Second Basis of Comparison												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,332	2,332	2,332	2,337	2,345	2,350	2,361	2,364	2,361	2,358	2,353	2,343
20%	2,328	2,331	2,332	2,337	2,345	2,350	2,359	2,360	2,355	2,348	2,338	2,330
30%	2,309	2,310	2,323	2,329	2,343	2,350	2,357	2,353	2,349	2,339	2,327	2,315
40%	2,293	2,298	2,308	2,320	2,333	2,346	2,352	2,347	2,338	2,325	2,309	2,296
50%	2,283	2,283	2,294	2,308	2,318	2,330	2,346	2,338	2,326	2,311	2,296	2,286
60%	2,273	2,276	2,279	2,289	2,306	2,320	2,326	2,324	2,318	2,302	2,288	2,278
70%	2,267	2,266	2,274	2,278	2,291	2,301	2,315	2,311	2,306	2,294	2,279	2,267
80%	2,249	2,250	2,253	2,261	2,269	2,283	2,299	2,297	2,289	2,273	2,261	2,252
90%	2,207	2,208	2,212	2,220	2,232	2,246	2,261	2,252	2,245	2,230	2,215	2,209
Long Term												
Full Simulation Period ^b	2,275	2,277	2,283	2,291	2,303	2,314	2,325	2,322	2,317	2,305	2,291	2,280
Water Year Types^c												
Wet (32%)	2,301	2,305	2,314	2,325	2,339	2,347	2,357	2,358	2,355	2,347	2,338	2,328
Above Normal (16%)	2,270	2,273	2,286	2,303	2,320	2,335	2,347	2,346	2,339	2,329	2,315	2,304
Below Normal (13%)	2,295	2,296	2,298	2,305	2,313	2,320	2,331	2,326	2,318	2,303	2,287	2,274
Dry (24%)	2,266	2,269	2,272	2,274	2,284	2,296	2,309	2,304	2,298	2,284	2,269	2,259
Critical (15%)	2,218	2,216	2,217	2,222	2,229	2,243	2,250	2,246	2,243	2,227	2,204	2,191

No Action Alternative												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,332	2,331	2,332	2,337	2,345	2,350	2,360	2,364	2,361	2,359	2,353	2,339
20%	2,325	2,322	2,328	2,336	2,345	2,350	2,358	2,359	2,356	2,348	2,337	2,324
30%	2,306	2,309	2,318	2,326	2,341	2,349	2,357	2,353	2,348	2,338	2,326	2,314
40%	2,293	2,292	2,307	2,317	2,325	2,343	2,351	2,346	2,338	2,326	2,310	2,297
50%	2,278	2,280	2,291	2,303	2,317	2,325	2,337	2,331	2,320	2,308	2,295	2,286
60%	2,268	2,271	2,280	2,284	2,302	2,317	2,327	2,321	2,313	2,296	2,282	2,271
70%	2,259	2,258	2,266	2,271	2,281	2,291	2,301	2,300	2,294	2,284	2,271	2,262
80%	2,235	2,238	2,241	2,252	2,259	2,270	2,287	2,284	2,278	2,262	2,246	2,236
90%	2,192	2,201	2,205	2,206	2,221	2,246	2,254	2,252	2,245	2,229	2,202	2,195
Long Term												
Full Simulation Period ^b	2,270	2,271	2,278	2,286	2,298	2,310	2,321	2,319	2,314	2,302	2,288	2,276
Water Year Types^c												
Wet (32%)	2,300	2,303	2,313	2,324	2,338	2,347	2,357	2,358	2,355	2,347	2,338	2,327
Above Normal (16%)	2,261	2,264	2,276	2,294	2,314	2,330	2,343	2,341	2,335	2,325	2,313	2,302
Below Normal (13%)	2,289	2,289	2,291	2,299	2,307	2,315	2,327	2,321	2,313	2,299	2,283	2,272
Dry (24%)	2,263	2,265	2,268	2,269	2,279	2,292	2,305	2,301	2,294	2,279	2,264	2,254
Critical (15%)	2,210	2,207	2,210	2,213	2,220	2,235	2,242	2,238	2,235	2,220	2,196	2,182

No Action Alternative minus Second Basis of Comparison												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	-1	0	0	0	0	-1	0	0	0	0	-4
20%	-3	-9	-5	-1	0	0	0	0	1	0	-1	-6
30%	-3	-1	-5	-4	-3	-1	0	0	-1	-1	-1	-1
40%	-1	-6	-1	-3	-7	-2	-1	0	0	1	0	1
50%	-5	-2	-2	-6	-2	-4	-8	-6	-6	-3	0	0
60%	-5	-5	1	-5	-3	-3	1	-3	-4	-6	-6	-7
70%	-8	-8	-8	-6	-10	-10	-13	-11	-12	-10	-7	-5
80%	-14	-12	-12	-9	-10	-14	-12	-13	-11	-11	-15	-16
90%	-15	-8	-7	-14	-11	0	-7	0	0	-2	-13	-14
Long Term												
Full Simulation Period ^b	-5	-5	-5	-5	-4	-4	-3	-4	-4	-3	-3	-4
Water Year Types^c												
Wet (32%)	-1	-2	-1	-1	-1	0	0	0	0	0	0	-2
Above Normal (16%)	-8	-10	-10	-9	-7	-5	-4	-4	-4	-4	-2	-2
Below Normal (13%)	-6	-7	-7	-6	-6	-6	-4	-5	-5	-4	-3	-3
Dry (24%)	-3	-4	-4	-5	-5	-4	-4	-4	-5	-5	-5	-5
Critical (15%)	-8	-8	-8	-9	-8	-8	-8	-8	-7	-8	-8	-9

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-8-5. Trinity Lake, End of Month Elevation

Second Basis of Comparison												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,332	2,332	2,332	2,337	2,345	2,350	2,361	2,364	2,361	2,358	2,353	2,343
20%	2,328	2,331	2,332	2,337	2,345	2,350	2,359	2,360	2,355	2,348	2,338	2,330
30%	2,309	2,310	2,323	2,329	2,343	2,350	2,357	2,353	2,349	2,339	2,327	2,315
40%	2,293	2,298	2,308	2,320	2,333	2,346	2,352	2,347	2,338	2,325	2,309	2,296
50%	2,283	2,283	2,294	2,308	2,318	2,330	2,346	2,338	2,326	2,311	2,296	2,286
60%	2,273	2,276	2,279	2,289	2,306	2,320	2,326	2,324	2,318	2,302	2,288	2,278
70%	2,267	2,266	2,274	2,278	2,291	2,301	2,315	2,311	2,306	2,294	2,279	2,267
80%	2,249	2,250	2,253	2,261	2,269	2,283	2,299	2,297	2,289	2,273	2,261	2,252
90%	2,207	2,208	2,212	2,220	2,232	2,246	2,261	2,252	2,245	2,230	2,215	2,209
Long Term												
Full Simulation Period ^b	2,275	2,277	2,283	2,291	2,303	2,314	2,325	2,322	2,317	2,305	2,291	2,280
Water Year Types^c												
Wet (32%)	2,301	2,305	2,314	2,325	2,339	2,347	2,357	2,358	2,355	2,347	2,338	2,328
Above Normal (16%)	2,270	2,273	2,286	2,303	2,320	2,335	2,347	2,346	2,339	2,329	2,315	2,304
Below Normal (13%)	2,295	2,296	2,298	2,305	2,313	2,320	2,331	2,326	2,318	2,303	2,287	2,274
Dry (24%)	2,266	2,269	2,272	2,274	2,284	2,296	2,309	2,304	2,298	2,284	2,269	2,259
Critical (15%)	2,218	2,216	2,217	2,222	2,229	2,243	2,250	2,246	2,243	2,227	2,204	2,191

Alternative 3												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,332	2,332	2,332	2,337	2,345	2,350	2,361	2,364	2,361	2,356	2,350	2,343
20%	2,329	2,331	2,332	2,337	2,345	2,350	2,359	2,358	2,356	2,348	2,337	2,330
30%	2,310	2,312	2,321	2,328	2,342	2,349	2,357	2,353	2,348	2,339	2,327	2,315
40%	2,291	2,294	2,309	2,317	2,333	2,345	2,351	2,347	2,340	2,324	2,309	2,296
50%	2,282	2,282	2,296	2,310	2,320	2,330	2,344	2,336	2,327	2,311	2,296	2,286
60%	2,273	2,276	2,279	2,287	2,306	2,321	2,327	2,324	2,317	2,302	2,289	2,278
70%	2,266	2,266	2,275	2,276	2,289	2,300	2,313	2,309	2,305	2,293	2,278	2,266
80%	2,245	2,250	2,251	2,260	2,272	2,281	2,297	2,295	2,288	2,272	2,257	2,248
90%	2,206	2,206	2,205	2,213	2,229	2,246	2,262	2,258	2,251	2,236	2,215	2,206
Long Term												
Full Simulation Period ^b	2,275	2,277	2,283	2,291	2,303	2,314	2,324	2,322	2,317	2,305	2,291	2,281
Water Year Types^c												
Wet (32%)	2,301	2,305	2,314	2,325	2,339	2,347	2,357	2,358	2,355	2,347	2,338	2,328
Above Normal (16%)	2,268	2,271	2,284	2,301	2,319	2,334	2,347	2,345	2,339	2,328	2,315	2,304
Below Normal (13%)	2,293	2,295	2,297	2,304	2,312	2,319	2,330	2,325	2,317	2,302	2,286	2,274
Dry (24%)	2,265	2,268	2,271	2,273	2,283	2,296	2,309	2,305	2,299	2,284	2,269	2,260
Critical (15%)	2,226	2,220	2,222	2,225	2,231	2,244	2,252	2,248	2,244	2,229	2,204	2,193

Alternative 3 minus Second Basis of Comparison												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	0	0	0	0	0	-2	-2	0
20%	1	-1	0	0	0	0	0	-2	1	0	-1	0
30%	1	2	-2	-1	-1	-1	0	0	-1	0	0	0
40%	-2	-4	0	-3	0	-1	-1	1	2	-1	0	-1
50%	-1	-1	2	2	1	0	-2	-1	1	0	0	0
60%	-1	0	0	-1	0	1	0	0	0	0	0	0
70%	-1	0	1	-2	-2	-1	-1	-2	-1	-1	0	-1
80%	-4	0	-2	-1	2	-2	-2	-2	-1	-1	-4	-5
90%	-1	-2	-7	-6	-3	0	2	5	6	6	0	-3
Long Term												
Full Simulation Period ^b	1	0	0	0	0	0	0	0	0	0	0	0
Water Year Types^c												
Wet (32%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (16%)	-2	-2	-2	-2	-1	-1	-1	-1	0	-1	0	0
Below Normal (13%)	-2	-2	-1	-1	-1	-1	-1	-1	-1	-1	0	-1
Dry (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (15%)	8	5	5	4	3	2	1	2	2	1	0	2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-8-6. Trinity Lake, End of Month Elevation

Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,332	2,332	2,332	2,337	2,345	2,350	2,361	2,364	2,361	2,358	2,353	2,343
20%	2,328	2,331	2,332	2,337	2,345	2,350	2,359	2,360	2,355	2,348	2,338	2,330
30%	2,309	2,310	2,323	2,329	2,343	2,350	2,357	2,353	2,349	2,339	2,327	2,315
40%	2,293	2,298	2,308	2,320	2,333	2,346	2,352	2,347	2,338	2,325	2,309	2,296
50%	2,283	2,283	2,294	2,308	2,318	2,330	2,346	2,338	2,326	2,311	2,296	2,286
60%	2,273	2,276	2,279	2,289	2,306	2,320	2,326	2,324	2,318	2,302	2,288	2,278
70%	2,267	2,266	2,274	2,278	2,291	2,301	2,315	2,311	2,306	2,294	2,279	2,267
80%	2,249	2,250	2,253	2,261	2,269	2,283	2,299	2,297	2,289	2,273	2,261	2,252
90%	2,207	2,208	2,212	2,220	2,232	2,246	2,261	2,252	2,245	2,230	2,215	2,209
Long Term												
Full Simulation Period ^b	2,275	2,277	2,283	2,291	2,303	2,314	2,325	2,322	2,317	2,305	2,291	2,280
Water Year Types^c												
Wet (32%)	2,301	2,305	2,314	2,325	2,339	2,347	2,357	2,358	2,355	2,347	2,338	2,328
Above Normal (16%)	2,270	2,273	2,286	2,303	2,320	2,335	2,347	2,346	2,339	2,329	2,315	2,304
Below Normal (13%)	2,295	2,296	2,298	2,305	2,313	2,320	2,331	2,326	2,318	2,303	2,287	2,274
Dry (24%)	2,266	2,269	2,272	2,274	2,284	2,296	2,309	2,304	2,298	2,284	2,269	2,259
Critical (15%)	2,218	2,216	2,217	2,222	2,229	2,243	2,250	2,246	2,243	2,227	2,204	2,191

Alternative 5

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,332	2,330	2,332	2,337	2,345	2,350	2,360	2,364	2,361	2,359	2,353	2,339
20%	2,325	2,322	2,328	2,336	2,345	2,350	2,358	2,360	2,356	2,348	2,336	2,323
30%	2,306	2,309	2,319	2,326	2,341	2,349	2,357	2,353	2,348	2,338	2,326	2,314
40%	2,296	2,292	2,308	2,318	2,325	2,344	2,352	2,347	2,338	2,326	2,311	2,299
50%	2,279	2,281	2,292	2,304	2,317	2,326	2,336	2,332	2,322	2,308	2,296	2,286
60%	2,269	2,273	2,281	2,284	2,302	2,317	2,328	2,321	2,314	2,301	2,283	2,271
70%	2,261	2,259	2,266	2,271	2,281	2,292	2,301	2,299	2,293	2,283	2,270	2,263
80%	2,235	2,238	2,241	2,252	2,259	2,270	2,288	2,282	2,277	2,262	2,248	2,235
90%	2,190	2,200	2,201	2,206	2,221	2,245	2,253	2,251	2,246	2,232	2,203	2,193
Long Term												
Full Simulation Period ^b	2,270	2,271	2,278	2,286	2,299	2,310	2,321	2,319	2,314	2,302	2,289	2,277
Water Year Types^c												
Wet (32%)	2,300	2,303	2,313	2,325	2,338	2,347	2,357	2,358	2,355	2,347	2,338	2,326
Above Normal (16%)	2,259	2,262	2,276	2,294	2,314	2,330	2,343	2,342	2,335	2,326	2,313	2,303
Below Normal (13%)	2,289	2,290	2,292	2,299	2,308	2,315	2,326	2,321	2,313	2,299	2,284	2,272
Dry (24%)	2,263	2,265	2,268	2,269	2,279	2,292	2,305	2,301	2,294	2,279	2,265	2,254
Critical (15%)	2,209	2,206	2,209	2,212	2,220	2,234	2,241	2,237	2,235	2,221	2,199	2,183

Alternative 5 minus Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	-2	0	0	0	0	-1	0	0	1	0	-4
20%	-3	-9	-4	-1	0	0	0	0	1	0	-2	-7
30%	-3	-1	-4	-3	-2	0	0	0	-1	-1	-1	-1
40%	3	-6	-1	-2	-7	-1	0	0	0	1	2	2
50%	-4	-1	-2	-4	-1	-4	-10	-6	-4	-3	0	0
60%	-5	-3	2	-5	-4	-3	2	-2	-4	-2	-5	-7
70%	-6	-7	-8	-7	-10	-9	-14	-12	-12	-11	-9	-5
80%	-14	-12	-12	-9	-10	-13	-11	-15	-12	-10	-13	-18
90%	-17	-8	-11	-14	-11	-1	-8	-1	1	2	-12	-16
Long Term												
Full Simulation Period ^b	-5	-5	-5	-5	-4	-4	-4	-4	-4	-4	-3	-2
Water Year Types^c												
Wet (32%)	-1	-2	-1	-1	0	0	0	0	0	0	0	-2
Above Normal (16%)	-10	-11	-11	-9	-7	-5	-4	-4	-4	-3	-2	-1
Below Normal (13%)	-5	-6	-6	-5	-5	-5	-5	-5	-5	-3	-3	-2
Dry (24%)	-2	-3	-3	-5	-4	-4	-4	-4	-4	-4	-5	-5
Critical (15%)	-9	-9	-8	-9	-9	-9	-9	-9	-8	-6	-5	-8

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 C.9. Shasta Lake Elevation

Figure C-9-1. Shasta Lake, Reservoir Pool Elevation, May

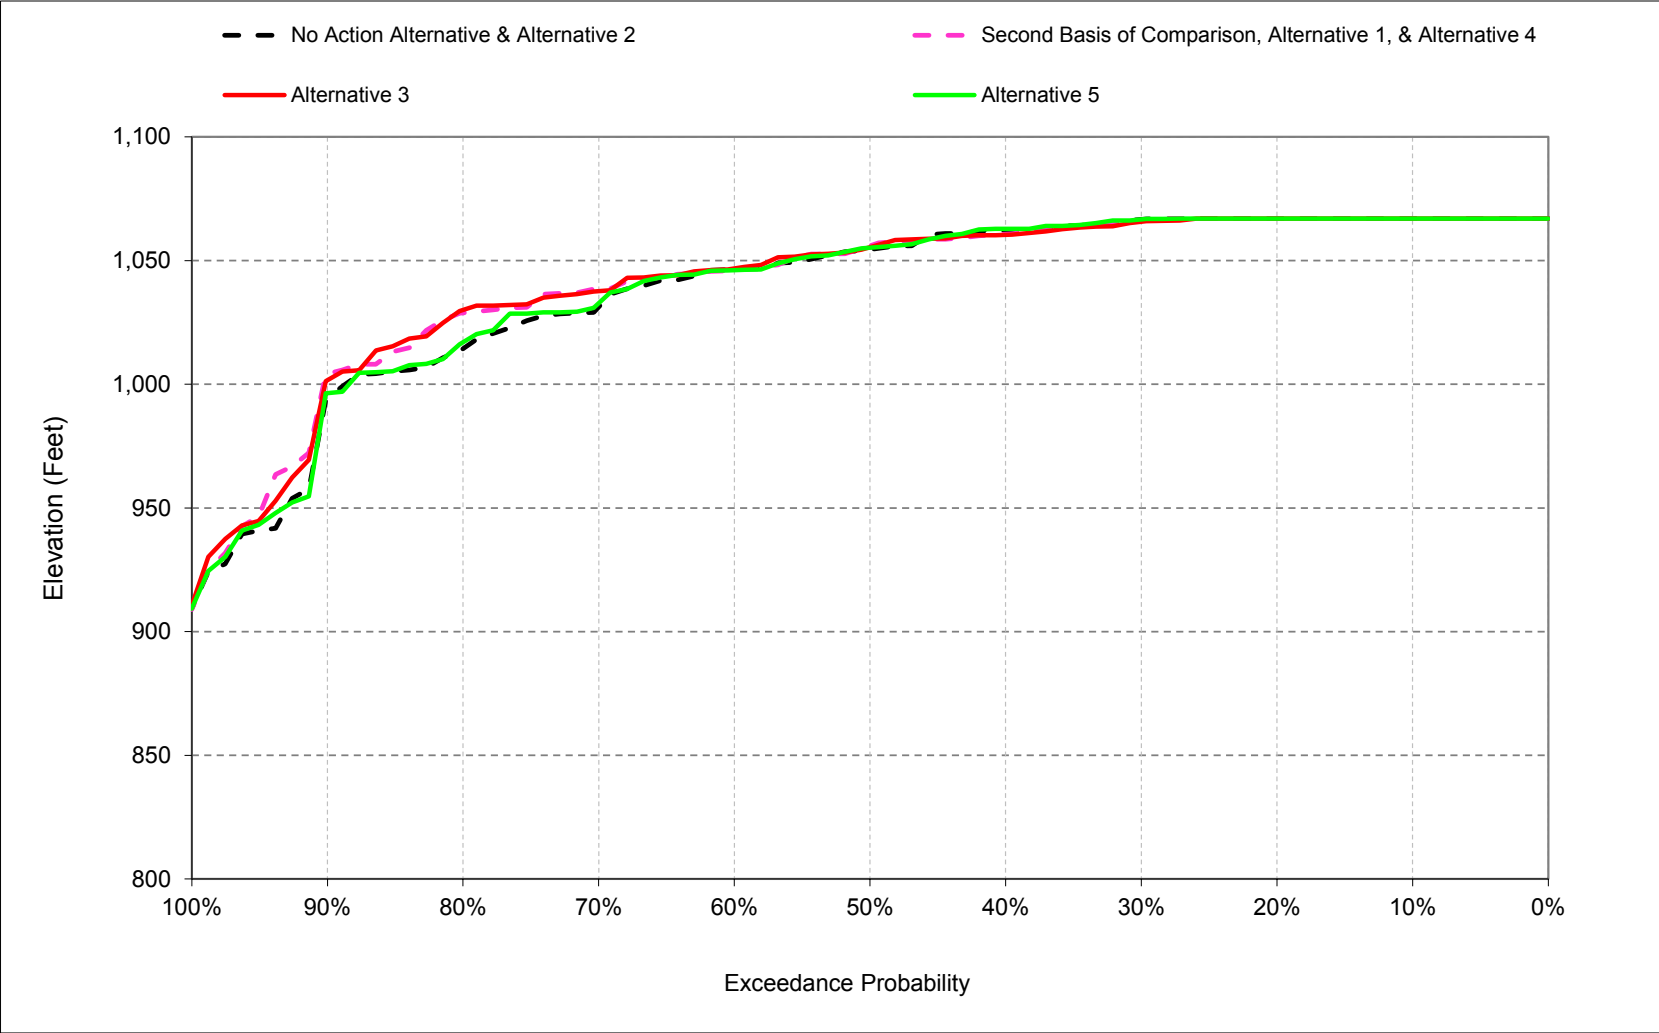

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-9-2. Shasta Lake, Reservoir Pool Elevation, September

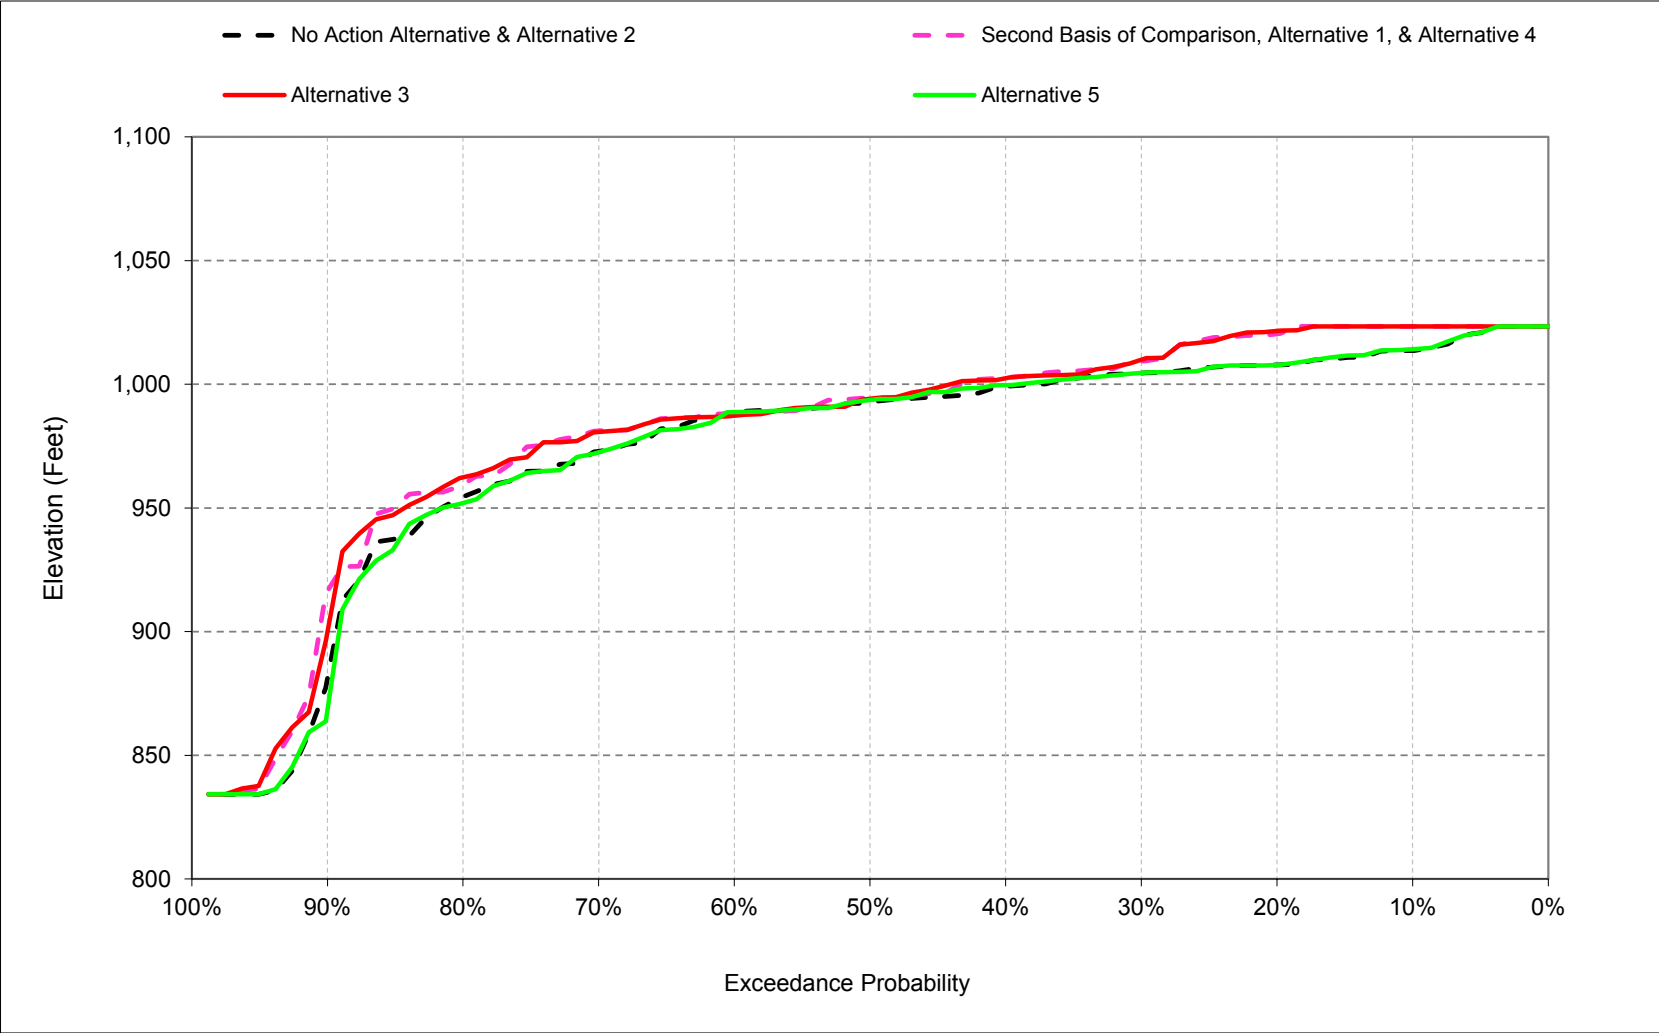

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-9-1. Shasta Lake, End of Month Elevation

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance ^a												
10%	1,015	1,015	1,020	1,033	1,041	1,055	1,064	1,067	1,063	1,044	1,031	1,014
20%	1,005	1,003	1,019	1,029	1,036	1,051	1,063	1,067	1,057	1,039	1,027	1,008
30%	1,000	996	1,017	1,022	1,033	1,047	1,061	1,067	1,054	1,031	1,016	1,005
40%	994	992	1,007	1,017	1,027	1,045	1,057	1,062	1,048	1,020	1,007	1,000
50%	988	986	996	1,013	1,023	1,039	1,052	1,054	1,039	1,014	999	994
60%	984	981	986	1,004	1,018	1,031	1,047	1,046	1,030	1,006	994	989
70%	969	970	975	990	1,012	1,024	1,038	1,031	1,019	993	984	974
80%	953	953	964	981	996	1,012	1,025	1,014	998	974	961	957
90%	907	905	912	954	967	987	993	994	976	943	917	914
Long Term												
Full Simulation Period ^b	972	971	982	998	1,012	1,028	1,038	1,038	1,024	1,000	985	976
Water Year Types ^c												
Wet (32%)	991	992	1,008	1,023	1,031	1,041	1,058	1,064	1,056	1,037	1,024	1,005
Above Normal (16%)	967	968	982	1,012	1,025	1,048	1,062	1,063	1,049	1,024	1,009	999
Below Normal (13%)	986	985	991	1,009	1,025	1,040	1,048	1,045	1,031	1,006	989	987
Dry (24%)	969	967	975	986	1,006	1,027	1,037	1,034	1,018	995	982	980
Critical (15%)	927	923	929	939	951	968	965	958	935	899	876	872

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 1												
Probability of Exceedance ^a												
10%	1,017	1,017	1,022	1,033	1,044	1,055	1,065	1,067	1,063	1,044	1,030	1,023
20%	1,017	1,017	1,020	1,030	1,039	1,051	1,063	1,067	1,057	1,039	1,023	1,020
30%	1,012	1,015	1,019	1,028	1,035	1,048	1,061	1,066	1,053	1,030	1,014	1,010
40%	1,003	1,007	1,017	1,023	1,031	1,046	1,058	1,061	1,044	1,019	1,005	1,003
50%	993	995	1,012	1,020	1,027	1,044	1,054	1,056	1,037	1,012	997	995
60%	985	988	1,003	1,013	1,021	1,037	1,050	1,046	1,027	1,004	990	988
70%	975	982	991	1,001	1,017	1,028	1,043	1,039	1,020	997	986	982
80%	961	964	966	989	1,005	1,024	1,034	1,029	1,004	979	963	963
90%	918	913	926	959	978	996	994	1,004	989	955	931	926
Long Term												
Full Simulation Period ^b	979	981	990	1,004	1,016	1,031	1,042	1,041	1,026	1,002	986	983
Water Year Types ^c												
Wet (32%)	997	1,002	1,012	1,024	1,032	1,041	1,058	1,063	1,055	1,037	1,022	1,017
Above Normal (16%)	974	978	992	1,019	1,028	1,048	1,062	1,062	1,046	1,021	1,005	1,003
Below Normal (13%)	997	998	1,004	1,019	1,034	1,046	1,053	1,049	1,031	1,006	987	986
Dry (24%)	972	974	982	992	1,012	1,032	1,041	1,038	1,020	997	984	982
Critical (15%)	938	935	941	950	961	977	974	967	943	910	889	884

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 1 minus No Action Alternative												
Probability of Exceedance ^a												
10%	2	2	2	1	4	0	1	0	-1	0	-1	10
20%	11	14	2	1	3	0	1	0	0	-1	-4	13
30%	12	19	2	6	2	1	0	0	-1	-1	-2	5
40%	9	15	10	5	3	1	1	-2	-3	-1	-2	4
50%	4	10	16	7	4	5	1	2	-2	-2	-3	1
60%	1	7	16	9	3	6	2	0	-3	-2	-3	-1
70%	6	12	15	12	5	4	5	7	1	4	2	7
80%	9	11	2	8	9	12	9	15	6	5	2	6
90%	11	8	14	5	11	9	1	10	13	12	13	13
Long Term												
Full Simulation Period ^b	7	10	8	6	5	4	3	3	1	2	1	7
Water Year Types ^c												
Wet (32%)	6	10	4	1	0	0	0	0	-1	0	-2	12
Above Normal (16%)	7	10	10	7	3	1	0	0	-2	-3	-4	4
Below Normal (13%)	11	14	13	10	9	6	5	4	1	1	-2	-1
Dry (24%)	3	7	7	6	6	6	5	4	2	2	3	2
Critical (15%)	11	12	12	11	10	9	9	9	8	11	13	12

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-9-2. Shasta Lake, End of Month Elevation

No Action Alternative												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1,015	1,015	1,020	1,033	1,041	1,055	1,064	1,067	1,063	1,044	1,031	1,014
20%	1,005	1,003	1,019	1,029	1,036	1,051	1,063	1,067	1,057	1,039	1,027	1,008
30%	1,000	996	1,017	1,022	1,033	1,047	1,061	1,067	1,054	1,031	1,016	1,005
40%	994	992	1,007	1,017	1,027	1,045	1,057	1,062	1,048	1,020	1,007	1,000
50%	988	986	996	1,013	1,023	1,039	1,052	1,054	1,039	1,014	999	994
60%	984	981	986	1,004	1,018	1,031	1,047	1,046	1,030	1,006	994	989
70%	969	970	975	990	1,012	1,024	1,038	1,031	1,019	993	984	974
80%	953	953	964	981	996	1,012	1,025	1,014	998	974	961	957
90%	907	905	912	954	967	987	993	994	976	943	917	914
Long Term												
Full Simulation Period ^b	972	971	982	998	1,012	1,028	1,038	1,038	1,024	1,000	985	976
Water Year Types ^c												
Wet (32%)	991	992	1,008	1,023	1,031	1,041	1,058	1,064	1,056	1,037	1,024	1,005
Above Normal (16%)	967	968	982	1,012	1,025	1,048	1,062	1,063	1,049	1,024	1,009	999
Below Normal (13%)	986	985	991	1,009	1,025	1,040	1,048	1,045	1,031	1,006	989	987
Dry (24%)	969	967	975	986	1,006	1,027	1,037	1,034	1,018	995	982	980
Critical (15%)	927	923	929	939	951	968	965	958	935	899	876	872

Alternative 3												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1,017	1,017	1,021	1,034	1,044	1,055	1,064	1,067	1,063	1,043	1,031	1,023
20%	1,015	1,017	1,020	1,030	1,039	1,052	1,063	1,067	1,057	1,039	1,024	1,022
30%	1,010	1,013	1,019	1,028	1,035	1,048	1,061	1,066	1,053	1,029	1,013	1,011
40%	1,003	1,009	1,017	1,022	1,032	1,046	1,057	1,060	1,044	1,019	1,006	1,003
50%	992	996	1,010	1,018	1,027	1,042	1,054	1,055	1,038	1,012	996	995
60%	983	988	1,003	1,014	1,020	1,038	1,050	1,047	1,028	1,006	992	988
70%	977	979	990	1,001	1,017	1,028	1,044	1,038	1,022	997	986	981
80%	962	962	969	989	1,005	1,023	1,034	1,030	1,006	983	966	964
90%	926	925	930	962	977	998	993	1,002	990	961	942	933
Long Term												
Full Simulation Period ^b	978	981	990	1,004	1,016	1,031	1,042	1,041	1,026	1,002	987	982
Water Year Types ^c												
Wet (32%)	997	1,002	1,012	1,024	1,032	1,041	1,058	1,063	1,055	1,036	1,022	1,017
Above Normal (16%)	973	976	990	1,018	1,028	1,048	1,062	1,062	1,046	1,021	1,006	1,004
Below Normal (13%)	997	998	1,004	1,019	1,034	1,046	1,054	1,049	1,032	1,008	991	986
Dry (24%)	974	976	983	993	1,013	1,033	1,042	1,039	1,021	998	985	983
Critical (15%)	935	933	939	948	960	975	972	966	941	910	888	882

Alternative 3 minus No Action Alternative												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	2	2	1	1	3	0	0	0	-1	-1	0	10
20%	9	14	1	1	3	0	0	0	0	-1	-3	14
30%	10	17	2	6	3	1	0	-1	-1	-2	-2	6
40%	9	17	10	5	5	1	0	-2	-3	-1	-1	3
50%	4	11	14	5	4	4	1	1	-1	-1	-3	1
60%	-1	7	16	9	2	7	3	0	-2	0	-2	-2
70%	8	9	15	11	5	4	6	6	3	4	3	7
80%	9	9	5	8	9	11	9	16	8	8	5	7
90%	20	20	18	8	10	11	0	8	14	17	25	20
Long Term												
Full Simulation Period ^b	7	10	8	6	5	4	3	3	1	2	2	6
Water Year Types ^c												
Wet (32%)	6	10	4	1	0	0	0	0	-1	-1	-2	12
Above Normal (16%)	5	8	8	6	2	0	0	-1	-2	-2	-3	5
Below Normal (13%)	11	14	13	10	9	6	6	4	2	2	2	-2
Dry (24%)	5	9	8	7	7	6	6	5	3	3	3	2
Critical (15%)	8	10	10	9	8	7	8	8	7	11	11	11

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-9-3. Shasta Lake, End of Month Elevation

No Action Alternative												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,015	1,015	1,020	1,033	1,041	1,055	1,064	1,067	1,063	1,044	1,031	1,014
20%	1,005	1,003	1,019	1,029	1,036	1,051	1,063	1,067	1,057	1,039	1,027	1,008
30%	1,000	996	1,017	1,022	1,033	1,047	1,061	1,067	1,054	1,031	1,016	1,005
40%	994	992	1,007	1,017	1,027	1,045	1,057	1,062	1,048	1,020	1,007	1,000
50%	988	986	996	1,013	1,023	1,039	1,052	1,054	1,039	1,014	999	994
60%	984	981	986	1,004	1,018	1,031	1,047	1,046	1,030	1,006	994	989
70%	969	970	975	990	1,012	1,024	1,038	1,031	1,019	993	984	974
80%	953	953	964	981	996	1,012	1,025	1,014	998	974	961	957
90%	907	905	912	954	967	987	993	994	976	943	917	914
Long Term												
Full Simulation Period ^b	972	971	982	998	1,012	1,028	1,038	1,038	1,024	1,000	985	976
Water Year Types^c												
Wet (32%)	991	992	1,008	1,023	1,031	1,041	1,058	1,064	1,056	1,037	1,024	1,005
Above Normal (16%)	967	968	982	1,012	1,025	1,048	1,062	1,063	1,049	1,024	1,009	999
Below Normal (13%)	986	985	991	1,009	1,025	1,040	1,048	1,045	1,031	1,006	989	987
Dry (24%)	969	967	975	986	1,006	1,027	1,037	1,034	1,018	995	982	980
Critical (15%)	927	923	929	939	951	968	965	958	935	899	876	872

Alternative 5												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,015	1,017	1,020	1,033	1,041	1,055	1,065	1,067	1,063	1,044	1,031	1,014
20%	1,007	1,002	1,019	1,029	1,037	1,051	1,063	1,067	1,057	1,039	1,026	1,008
30%	1,001	996	1,017	1,022	1,033	1,047	1,061	1,067	1,054	1,031	1,016	1,005
40%	995	992	1,008	1,018	1,028	1,045	1,057	1,063	1,046	1,020	1,007	1,000
50%	989	986	996	1,014	1,023	1,039	1,052	1,055	1,040	1,015	1,000	994
60%	984	981	986	1,005	1,018	1,032	1,047	1,046	1,032	1,007	995	989
70%	970	970	976	990	1,013	1,024	1,038	1,033	1,019	994	984	974
80%	951	953	964	981	996	1,013	1,027	1,017	1,000	976	959	955
90%	904	902	908	952	970	987	992	996	980	944	913	910
Long Term												
Full Simulation Period ^b	972	971	982	998	1,012	1,028	1,038	1,039	1,025	1,001	985	976
Water Year Types^c												
Wet (32%)	991	992	1,008	1,023	1,031	1,041	1,058	1,064	1,056	1,037	1,024	1,005
Above Normal (16%)	967	968	982	1,012	1,025	1,048	1,062	1,063	1,049	1,024	1,009	999
Below Normal (13%)	987	985	992	1,009	1,025	1,040	1,048	1,045	1,031	1,006	990	988
Dry (24%)	969	967	975	986	1,006	1,027	1,037	1,035	1,019	996	982	980
Critical (15%)	925	921	928	938	950	967	965	959	937	899	874	869

Alternative 5 minus No Action Alternative												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	1	0	0	0	0	0	0	0	0	0	1
20%	1	-1	0	0	0	0	0	0	0	-1	0	0
30%	1	0	0	0	0	0	0	0	0	0	1	0
40%	1	0	1	0	0	0	0	0	-1	0	0	1
50%	1	0	1	1	0	0	0	1	0	1	1	0
60%	0	0	0	0	0	1	0	0	2	1	1	0
70%	1	0	1	1	1	0	1	2	0	1	0	0
80%	-2	0	0	0	0	1	2	3	2	2	-3	-3
90%	-3	-3	-4	-2	3	1	-1	2	4	1	-4	-3
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	1	1	0	0	0
Water Year Types^c												
Wet (32%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (13%)	1	1	1	1	0	0	1	1	1	0	1	1
Dry (24%)	0	0	0	0	0	0	0	1	1	1	0	0
Critical (15%)	-2	-2	-1	-1	-1	-1	0	1	3	-1	-2	-2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-9-4. Shasta Lake, End of Month Elevation

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance^a												
10%	1,017	1,017	1,022	1,033	1,044	1,055	1,065	1,067	1,063	1,044	1,030	1,023
20%	1,017	1,017	1,020	1,030	1,039	1,051	1,063	1,067	1,057	1,039	1,023	1,020
30%	1,012	1,015	1,019	1,028	1,035	1,048	1,061	1,066	1,053	1,030	1,014	1,010
40%	1,003	1,007	1,017	1,023	1,031	1,046	1,058	1,061	1,044	1,019	1,005	1,003
50%	993	995	1,012	1,020	1,027	1,044	1,054	1,056	1,037	1,012	997	995
60%	985	988	1,003	1,013	1,021	1,037	1,050	1,046	1,027	1,004	990	988
70%	975	982	991	1,001	1,017	1,028	1,043	1,039	1,020	997	986	982
80%	961	964	966	989	1,005	1,024	1,034	1,029	1,004	979	963	963
90%	918	913	926	959	978	996	994	1,004	989	955	931	926
Long Term												
Full Simulation Period ^b	979	981	990	1,004	1,016	1,031	1,042	1,041	1,026	1,002	986	983
Water Year Types^c												
Wet (32%)	997	1,002	1,012	1,024	1,032	1,041	1,058	1,063	1,055	1,037	1,022	1,017
Above Normal (16%)	974	978	992	1,019	1,028	1,048	1,062	1,062	1,046	1,021	1,005	1,003
Below Normal (13%)	997	998	1,004	1,019	1,034	1,046	1,053	1,049	1,031	1,006	987	986
Dry (24%)	972	974	982	992	1,012	1,032	1,041	1,038	1,020	997	984	982
Critical (15%)	938	935	941	950	961	977	974	967	943	910	889	884

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance^a												
10%	1,015	1,015	1,020	1,033	1,041	1,055	1,064	1,067	1,063	1,044	1,031	1,014
20%	1,005	1,003	1,019	1,029	1,036	1,051	1,063	1,067	1,057	1,039	1,027	1,008
30%	1,000	996	1,017	1,022	1,033	1,047	1,061	1,067	1,054	1,031	1,016	1,005
40%	994	992	1,007	1,017	1,027	1,045	1,057	1,062	1,048	1,020	1,007	1,000
50%	988	986	996	1,013	1,023	1,039	1,052	1,054	1,039	1,014	999	994
60%	984	981	986	1,004	1,018	1,031	1,047	1,046	1,030	1,006	994	989
70%	969	970	975	990	1,012	1,024	1,038	1,031	1,019	993	984	974
80%	953	953	964	981	996	1,012	1,025	1,014	998	974	961	957
90%	907	905	912	954	967	987	993	994	976	943	917	914
Long Term												
Full Simulation Period ^b	972	971	982	998	1,012	1,028	1,038	1,038	1,024	1,000	985	976
Water Year Types^c												
Wet (32%)	991	992	1,008	1,023	1,031	1,041	1,058	1,064	1,056	1,037	1,024	1,005
Above Normal (16%)	967	968	982	1,012	1,025	1,048	1,062	1,063	1,049	1,024	1,009	999
Below Normal (13%)	986	985	991	1,009	1,025	1,040	1,048	1,045	1,031	1,006	989	987
Dry (24%)	969	967	975	986	1,006	1,027	1,037	1,034	1,018	995	982	980
Critical (15%)	927	923	929	939	951	968	965	958	935	899	876	872

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative minus Second Basis of Comparison												
Probability of Exceedance^a												
10%	-2	-2	-2	-1	-4	0	-1	0	1	0	1	-10
20%	-11	-14	-2	-1	-3	0	-1	0	0	1	4	-13
30%	-12	-19	-2	-6	-2	-1	0	0	1	1	2	-5
40%	-9	-15	-10	-5	-3	-1	-1	2	3	1	2	-4
50%	-4	-10	-16	-7	-4	-5	-1	-2	2	2	3	-1
60%	-1	-7	-16	-9	-3	-6	-2	0	3	2	3	1
70%	-6	-12	-15	-12	-5	-4	-5	-7	-1	-4	-2	-7
80%	-9	-11	-2	-8	-9	-12	-9	-15	-6	-5	-2	-6
90%	-11	-8	-14	-5	-11	-9	-1	-10	-13	-12	-13	-13
Long Term												
Full Simulation Period ^b	-7	-10	-8	-6	-5	-4	-3	-3	-1	-2	-1	-7
Water Year Types^c												
Wet (32%)	-6	-10	-4	-1	0	0	0	0	1	0	2	-12
Above Normal (16%)	-7	-10	-10	-7	-3	-1	0	0	2	3	4	-4
Below Normal (13%)	-11	-14	-13	-10	-9	-6	-5	-4	-1	-1	2	1
Dry (24%)	-3	-7	-7	-6	-6	-6	-5	-4	-2	-2	-3	-2
Critical (15%)	-11	-12	-12	-11	-10	-9	-9	-9	-8	-11	-13	-12

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-9-5. Shasta Lake, End of Month Elevation

Second Basis of Comparison		End of Month Elevation (Feet)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	1,017	1,017	1,022	1,033	1,044	1,055	1,065	1,067	1,063	1,044	1,030	1,023	
20%	1,017	1,017	1,020	1,030	1,039	1,051	1,063	1,067	1,057	1,039	1,023	1,020	
30%	1,012	1,015	1,019	1,028	1,035	1,048	1,061	1,066	1,053	1,030	1,014	1,010	
40%	1,003	1,007	1,017	1,023	1,031	1,046	1,058	1,061	1,044	1,019	1,005	1,003	
50%	993	995	1,012	1,020	1,027	1,044	1,054	1,056	1,037	1,012	997	995	
60%	985	988	1,003	1,013	1,021	1,037	1,050	1,046	1,027	1,004	990	988	
70%	975	982	991	1,001	1,017	1,028	1,043	1,039	1,020	997	986	982	
80%	961	964	966	989	1,005	1,024	1,034	1,029	1,004	979	963	963	
90%	918	913	926	959	978	996	994	1,004	989	955	931	926	
Long Term													
Full Simulation Period ^b	979	981	990	1,004	1,016	1,031	1,042	1,041	1,026	1,002	986	983	
Water Year Types^c													
Wet (32%)	997	1,002	1,012	1,024	1,032	1,041	1,058	1,063	1,055	1,037	1,022	1,017	
Above Normal (16%)	974	978	992	1,019	1,028	1,048	1,062	1,062	1,046	1,021	1,005	1,003	
Below Normal (13%)	997	998	1,004	1,019	1,034	1,046	1,053	1,049	1,031	1,006	987	986	
Dry (24%)	972	974	982	992	1,012	1,032	1,041	1,038	1,020	997	984	982	
Critical (15%)	938	935	941	950	961	977	974	967	943	910	889	884	

Alternative 3		End of Month Elevation (Feet)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	1,017	1,017	1,021	1,034	1,044	1,055	1,064	1,067	1,063	1,043	1,031	1,023	
20%	1,015	1,017	1,020	1,030	1,039	1,052	1,063	1,067	1,057	1,039	1,024	1,022	
30%	1,010	1,013	1,019	1,028	1,035	1,048	1,061	1,066	1,053	1,029	1,013	1,011	
40%	1,003	1,009	1,017	1,022	1,032	1,046	1,057	1,060	1,044	1,019	1,006	1,003	
50%	992	996	1,010	1,018	1,027	1,042	1,054	1,055	1,038	1,012	996	995	
60%	983	988	1,003	1,014	1,020	1,038	1,050	1,047	1,028	1,006	992	988	
70%	977	979	990	1,001	1,017	1,028	1,044	1,038	1,022	997	986	981	
80%	962	962	969	989	1,005	1,023	1,034	1,030	1,006	983	966	964	
90%	926	925	930	962	977	998	993	1,002	990	961	942	933	
Long Term													
Full Simulation Period ^b	978	981	990	1,004	1,016	1,031	1,042	1,041	1,026	1,002	987	982	
Water Year Types^c													
Wet (32%)	997	1,002	1,012	1,024	1,032	1,041	1,058	1,063	1,055	1,036	1,022	1,017	
Above Normal (16%)	973	976	990	1,018	1,028	1,048	1,062	1,062	1,046	1,021	1,006	1,004	
Below Normal (13%)	997	998	1,004	1,019	1,034	1,046	1,054	1,049	1,032	1,008	991	986	
Dry (24%)	974	976	983	993	1,013	1,033	1,042	1,039	1,021	998	985	983	
Critical (15%)	935	933	939	948	960	975	972	966	941	910	888	882	

Alternative 3 minus Second Basis of Comparison		End of Month Elevation (Feet)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	0	0	0	0	0	0	-1	0	0	-1	1	0	
20%	-2	0	0	0	0	0	0	0	0	0	2	1	
30%	-1	-2	0	0	0	0	0	-1	0	-1	0	0	
40%	0	2	0	-1	1	0	0	0	0	0	1	0	
50%	0	1	-2	-2	0	-2	0	-1	1	0	-1	0	
60%	-3	0	0	0	-1	1	0	1	0	2	1	-1	
70%	2	-3	0	0	0	0	0	-1	2	1	1	0	
80%	0	-2	3	0	0	-1	0	1	2	4	3	1	
90%	8	12	4	3	-1	2	-1	-3	1	6	11	7	
Long Term													
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	1	0	
Water Year Types^c													
Wet (32%)	0	0	0	0	0	0	0	0	0	-1	0	0	
Above Normal (16%)	-2	-2	-2	-1	0	-1	0	-1	0	0	1	1	
Below Normal (13%)	0	0	0	0	0	0	0	1	1	1	4	0	
Dry (24%)	2	2	1	1	1	1	1	1	1	1	0	0	
Critical (15%)	-3	-2	-2	-2	-2	-2	-1	-1	-1	0	-1	-1	

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-9-6. Shasta Lake, End of Month Elevation

Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,017	1,017	1,022	1,033	1,044	1,055	1,065	1,067	1,063	1,044	1,030	1,023
20%	1,017	1,017	1,020	1,030	1,039	1,051	1,063	1,067	1,057	1,039	1,023	1,020
30%	1,012	1,015	1,019	1,028	1,035	1,048	1,061	1,066	1,053	1,030	1,014	1,010
40%	1,003	1,007	1,017	1,023	1,031	1,046	1,058	1,061	1,044	1,019	1,005	1,003
50%	993	995	1,012	1,020	1,027	1,044	1,054	1,056	1,037	1,012	997	995
60%	985	988	1,003	1,013	1,021	1,037	1,050	1,046	1,027	1,004	990	988
70%	975	982	991	1,001	1,017	1,028	1,043	1,039	1,020	997	986	982
80%	961	964	966	989	1,005	1,024	1,034	1,029	1,004	979	963	963
90%	918	913	926	959	978	996	994	1,004	989	955	931	926
Long Term												
Full Simulation Period ^b	979	981	990	1,004	1,016	1,031	1,042	1,041	1,026	1,002	986	983
Water Year Types^c												
Wet (32%)	997	1,002	1,012	1,024	1,032	1,041	1,058	1,063	1,055	1,037	1,022	1,017
Above Normal (16%)	974	978	992	1,019	1,028	1,048	1,062	1,062	1,046	1,021	1,005	1,003
Below Normal (13%)	997	998	1,004	1,019	1,034	1,046	1,053	1,049	1,031	1,006	987	986
Dry (24%)	972	974	982	992	1,012	1,032	1,041	1,038	1,020	997	984	982
Critical (15%)	938	935	941	950	961	977	974	967	943	910	889	884

Alternative 5

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,015	1,017	1,020	1,033	1,041	1,055	1,065	1,067	1,063	1,044	1,031	1,014
20%	1,007	1,002	1,019	1,029	1,037	1,051	1,063	1,067	1,057	1,039	1,026	1,008
30%	1,001	996	1,017	1,022	1,033	1,047	1,061	1,067	1,054	1,031	1,016	1,005
40%	995	992	1,008	1,018	1,028	1,045	1,057	1,063	1,046	1,020	1,007	1,000
50%	989	986	996	1,014	1,023	1,039	1,052	1,055	1,040	1,015	1,000	994
60%	984	981	986	1,005	1,018	1,032	1,047	1,046	1,032	1,007	995	989
70%	970	970	976	990	1,013	1,024	1,038	1,033	1,019	994	984	974
80%	951	953	964	981	996	1,013	1,027	1,017	1,000	976	959	955
90%	904	902	908	952	970	987	992	996	980	944	913	910
Long Term												
Full Simulation Period ^b	972	971	982	998	1,012	1,028	1,038	1,039	1,025	1,001	985	976
Water Year Types^c												
Wet (32%)	991	992	1,008	1,023	1,031	1,041	1,058	1,064	1,056	1,037	1,024	1,005
Above Normal (16%)	967	968	982	1,012	1,025	1,048	1,062	1,063	1,049	1,024	1,009	999
Below Normal (13%)	987	985	992	1,009	1,025	1,040	1,048	1,045	1,031	1,006	990	988
Dry (24%)	969	967	975	986	1,006	1,027	1,037	1,035	1,019	996	982	980
Critical (15%)	925	921	928	938	950	967	965	959	937	899	874	869

Alternative 5 minus Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-2	0	-2	-1	-4	0	0	0	1	0	1	-9
20%	-10	-15	-2	-1	-2	0	-1	0	0	0	4	-13
30%	-11	-19	-2	-6	-2	-1	0	0	1	1	3	-5
40%	-8	-15	-9	-5	-3	-1	-1	2	2	1	2	-3
50%	-3	-9	-16	-5	-4	-6	-1	-1	3	2	3	-1
60%	-1	-7	-17	-9	-3	-6	-3	0	4	3	4	1
70%	-6	-12	-15	-11	-4	-4	-5	-6	-2	-3	-2	-7
80%	-11	-11	-2	-8	-9	-11	-7	-12	-4	-3	-4	-8
90%	-15	-11	-18	-7	-8	-8	-2	-8	-9	-11	-18	-16
Long Term												
Full Simulation Period ^b	-7	-10	-8	-6	-5	-4	-3	-2	0	-1	-1	-7
Water Year Types^c												
Wet (32%)	-6	-10	-4	-1	0	0	0	0	1	0	2	-12
Above Normal (16%)	-7	-10	-10	-7	-3	-1	-1	0	2	3	4	-4
Below Normal (13%)	-10	-13	-12	-10	-8	-6	-5	-3	0	0	3	2
Dry (24%)	-3	-7	-7	-6	-6	-5	-4	-3	-1	-1	-3	-2
Critical (15%)	-13	-14	-14	-12	-11	-10	-9	-8	-5	-11	-15	-14

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 C.10. Oroville Lake Elevation

Figure C-10-1. Lake Oroville, Reservoir Pool Elevation, May

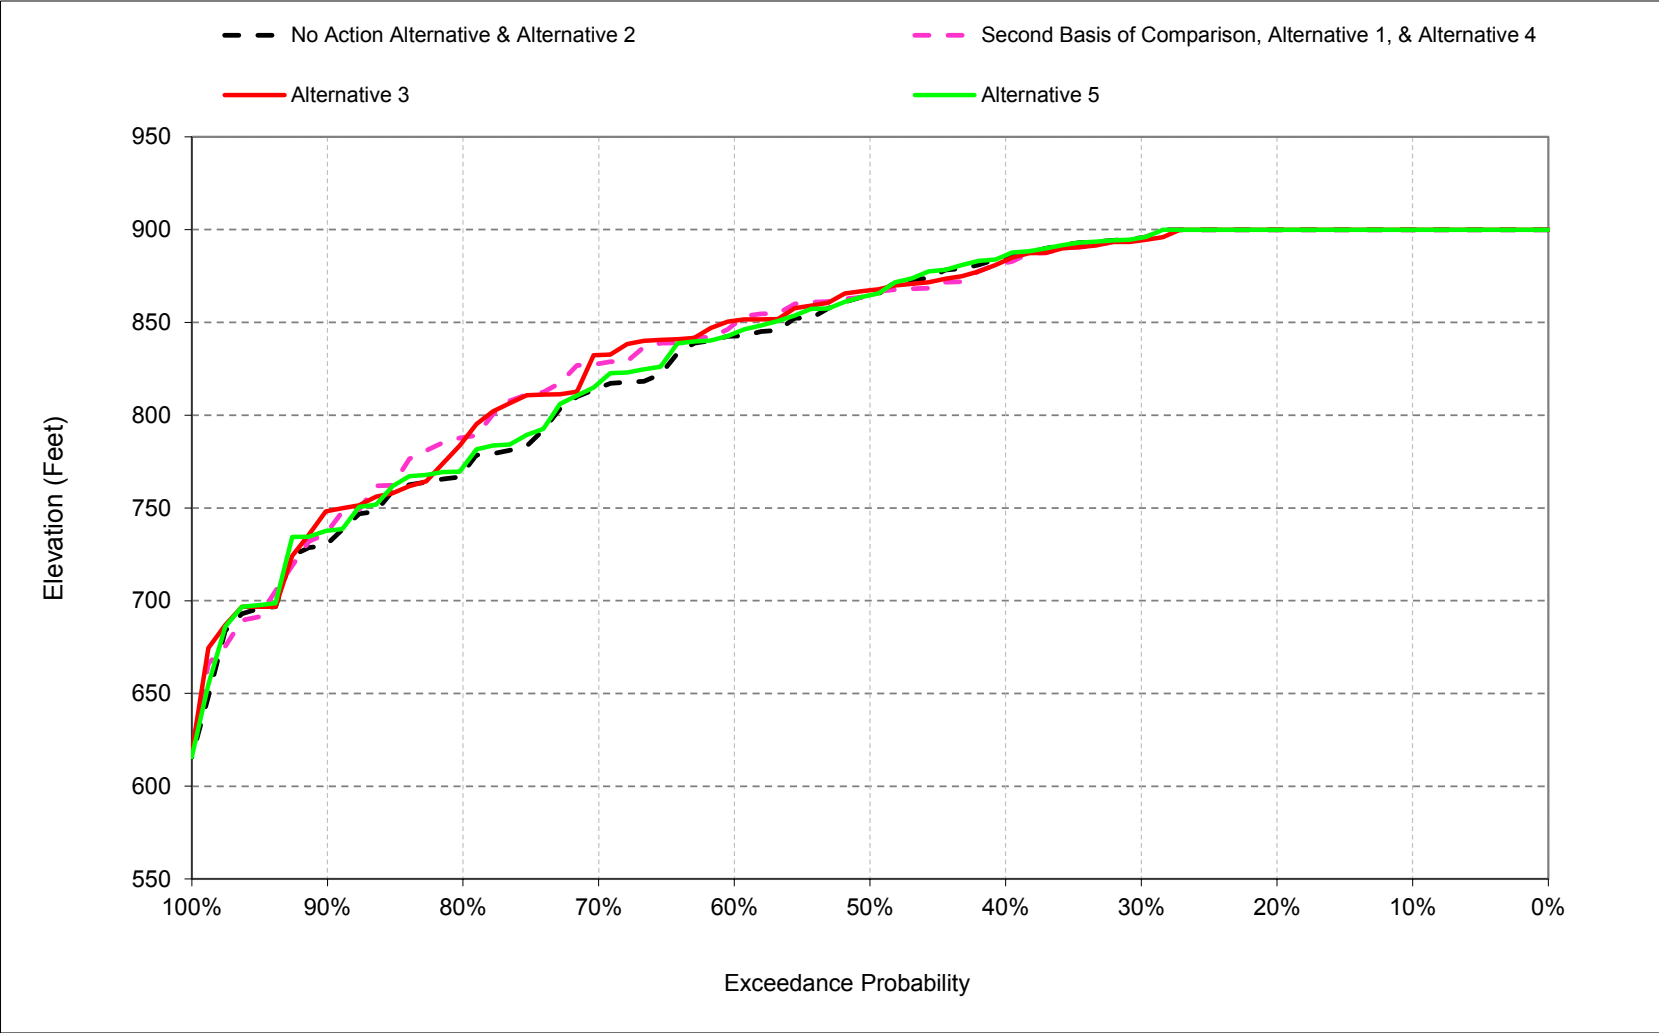

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-10-2. Lake Oroville, Reservoir Pool Elevation, September

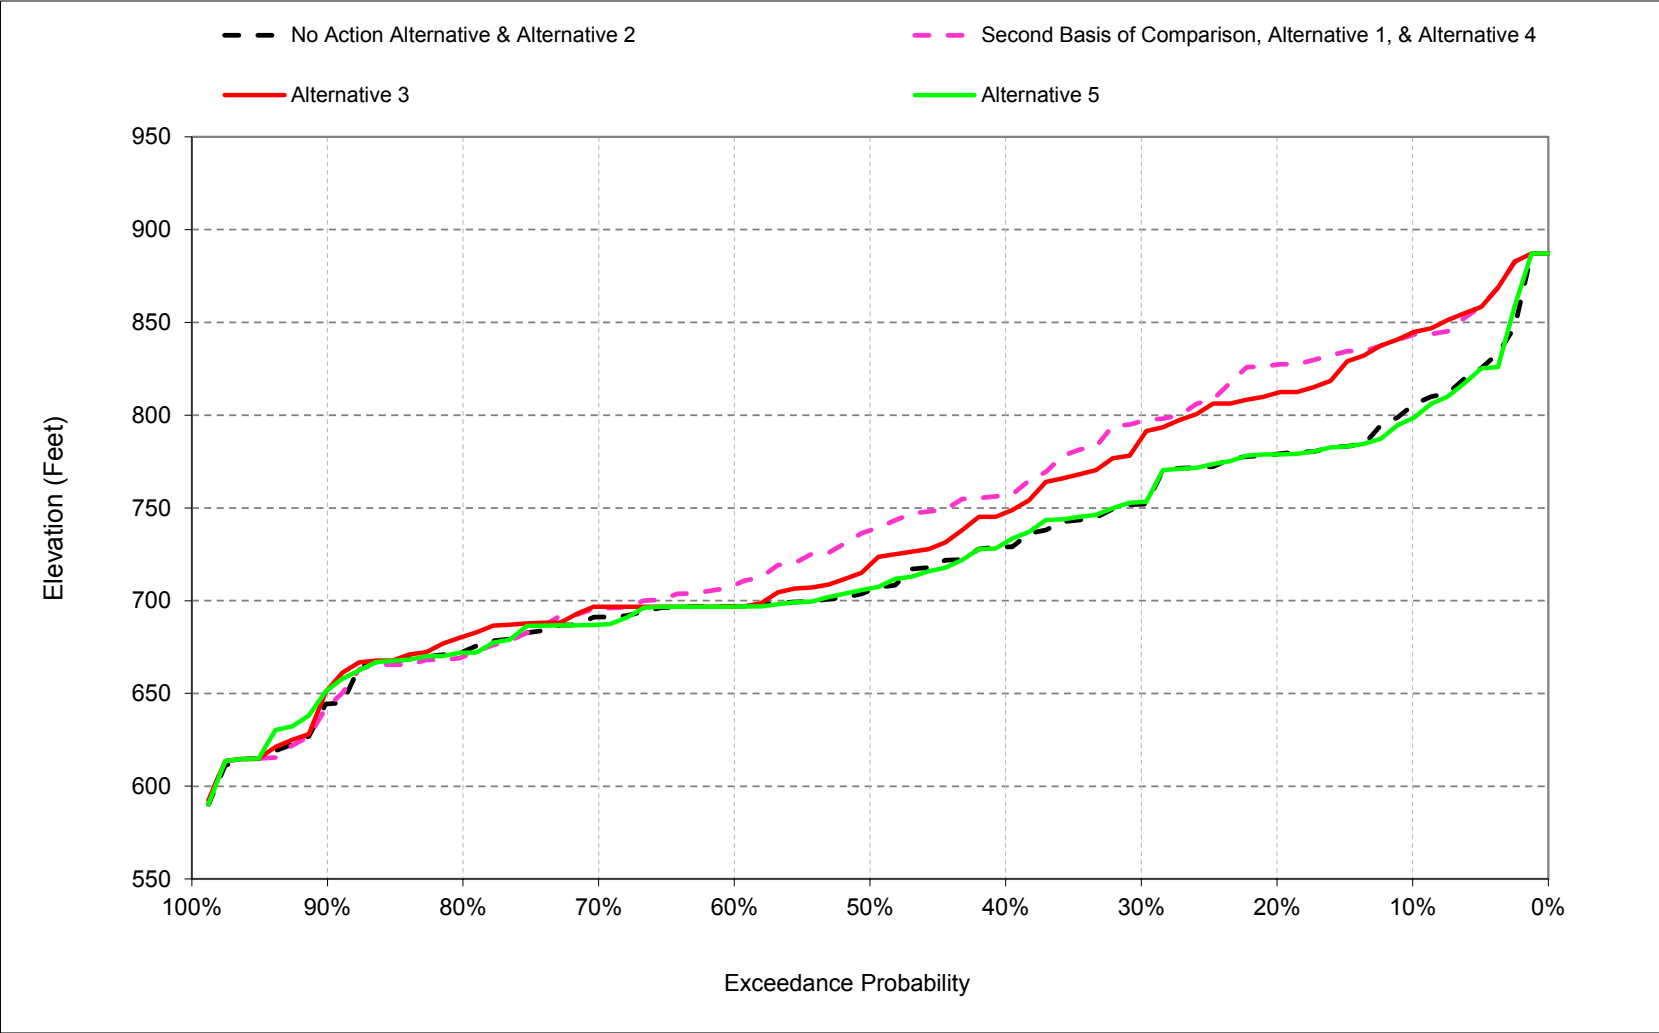

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-10-1. Lake Oroville, End of Month Elevation

No Action Alternative												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	788	795	844	849	858	866	887	900	900	866	847	805
20%	760	762	786	837	849	861	884	900	900	860	829	779
30%	742	748	762	813	849	856	882	896	888	846	815	765
40%	716	717	739	776	833	849	877	885	871	827	779	733
50%	697	697	715	751	800	839	858	865	852	804	755	708
60%	687	682	698	740	773	810	836	843	826	765	729	697
70%	679	669	679	704	749	786	805	815	783	723	698	691
80%	668	658	665	685	719	751	773	769	750	696	683	676
90%	650	648	648	668	696	727	749	731	699	679	664	647
Long Term												
Full Simulation Period ^b	711	710	728	758	789	811	831	838	824	783	755	724
Water Year Types ^c												
Wet (32%)	743	748	794	829	852	859	884	897	894	861	836	790
Above Normal (16%)	698	703	722	776	828	856	880	890	879	835	794	746
Below Normal (13%)	730	725	726	751	793	818	838	842	828	773	729	704
Dry (24%)	688	683	686	704	737	775	798	800	775	724	702	684
Critical (15%)	674	667	664	678	693	712	715	712	693	663	648	640

Alternative 1												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	837	832	849	850	860	867	887	900	900	866	853	843
20%	811	814	827	849	852	863	884	900	900	861	835	827
30%	776	786	800	833	849	859	882	896	883	848	823	797
40%	752	761	785	820	849	852	877	882	862	820	783	762
50%	719	721	754	802	834	849	868	865	840	798	762	741
60%	685	679	716	754	797	839	856	849	825	774	740	712
70%	672	667	677	704	770	807	831	828	789	758	719	696
80%	666	662	666	680	733	763	782	788	759	720	695	673
90%	651	644	647	667	691	725	736	737	707	683	666	652
Long Term												
Full Simulation Period ^b	730	729	746	771	799	818	838	842	823	788	762	744
Water Year Types ^c												
Wet (32%)	768	773	810	837	854	859	884	896	891	861	844	831
Above Normal (16%)	717	723	745	796	838	859	882	888	869	826	790	763
Below Normal (13%)	757	752	757	779	812	834	854	852	823	775	743	719
Dry (24%)	706	701	705	721	755	791	814	813	784	748	718	698
Critical (15%)	677	668	668	680	694	715	716	714	691	664	647	636

Alternative 1 minus No Action Alternative												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	49	38	5	1	2	1	0	0	0	0	7	38
20%	51	52	40	12	3	2	0	0	0	1	6	48
30%	34	39	37	20	0	3	0	0	-5	2	8	32
40%	36	44	46	44	16	4	0	-3	-9	-7	4	28
50%	22	24	39	51	34	10	10	1	-12	-6	7	34
60%	-2	-2	18	14	24	29	20	6	-1	9	11	14
70%	-7	-2	-2	0	20	20	26	13	6	34	20	5
80%	-2	4	1	-4	15	12	9	19	9	24	12	-3
90%	1	-3	-2	-1	-5	-2	-13	6	8	4	2	5
Long Term												
Full Simulation Period ^b	19	19	18	14	10	7	6	4	-1	5	8	21
Water Year Types ^c												
Wet (32%)	24	25	16	8	3	0	0	-1	-3	0	8	41
Above Normal (16%)	19	21	24	20	10	3	2	-3	-10	-10	-4	18
Below Normal (13%)	27	27	31	28	20	17	16	9	-5	1	14	14
Dry (24%)	18	18	18	17	18	16	15	14	9	24	17	15
Critical (15%)	3	1	3	3	1	3	2	2	-2	0	-1	-4

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-10-2. Lake Oroville, End of Month Elevation

No Action Alternative												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	788	795	844	849	858	866	887	900	900	866	847	805
20%	760	762	786	837	849	861	884	900	900	860	829	779
30%	742	748	762	813	849	856	882	896	888	846	815	765
40%	716	717	739	776	833	849	877	885	871	827	779	733
50%	697	697	715	751	800	839	858	865	852	804	755	708
60%	687	682	698	740	773	810	836	843	826	765	729	697
70%	679	669	679	704	749	786	805	815	783	723	698	691
80%	668	658	665	685	719	751	773	769	750	696	683	676
90%	650	648	648	668	696	727	749	731	699	679	664	647
Long Term												
Full Simulation Period ^b	711	710	728	758	789	811	831	838	824	783	755	724
Water Year Types ^c												
Wet (32%)	743	748	794	829	852	859	884	897	894	861	836	790
Above Normal (16%)	698	703	722	776	828	856	880	890	879	835	794	746
Below Normal (13%)	730	725	726	751	793	818	838	842	828	773	729	704
Dry (24%)	688	683	686	704	737	775	798	800	775	724	702	684
Critical (15%)	674	667	664	678	693	712	715	712	693	663	648	640

Alternative 3												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	839	832	849	850	859	867	887	900	900	866	849	845
20%	793	799	829	849	850	862	884	900	899	856	830	812
30%	773	771	791	826	849	859	882	894	875	833	811	787
40%	745	751	768	811	844	852	877	883	860	815	781	752
50%	699	703	746	794	834	849	869	867	846	794	753	724
60%	691	682	713	750	796	839	855	851	826	769	719	698
70%	680	674	680	710	765	801	831	832	802	741	705	697
80%	670	660	666	686	723	756	786	786	757	709	697	684
90%	652	650	650	669	696	723	748	748	703	687	673	662
Long Term												
Full Simulation Period ^b	727	726	744	770	798	818	838	842	824	783	755	739
Water Year Types ^c												
Wet (32%)	763	767	805	834	853	859	884	895	889	856	836	825
Above Normal (16%)	711	717	738	791	836	859	882	889	872	827	786	758
Below Normal (13%)	758	754	759	781	813	835	854	855	836	780	730	710
Dry (24%)	702	697	703	720	752	789	811	810	779	733	709	691
Critical (15%)	679	671	671	684	699	718	719	718	693	665	648	640

Alternative 3 minus No Action Alternative												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	50	38	5	1	2	1	0	0	0	1	2	39
20%	33	37	43	12	1	1	0	0	-1	-4	1	33
30%	31	24	28	13	0	3	0	-1	-13	-13	-4	23
40%	29	34	29	36	11	3	0	-2	-11	-12	2	19
50%	2	6	31	43	33	10	11	3	-6	-10	-2	17
60%	4	1	15	10	23	29	19	8	-1	4	-10	0
70%	1	5	2	6	16	15	26	18	19	18	6	5
80%	1	2	1	2	4	5	13	17	6	13	14	8
90%	1	2	2	1	0	-4	-1	18	4	8	10	15
Long Term												
Full Simulation Period ^b	16	16	15	13	9	7	6	4	-1	0	1	16
Water Year Types ^c												
Wet (32%)	19	19	11	5	2	0	0	-1	-5	-5	0	35
Above Normal (16%)	13	14	16	15	9	4	2	-2	-7	-9	-9	13
Below Normal (13%)	28	29	32	30	21	17	16	13	8	6	1	6
Dry (24%)	14	14	16	16	15	13	13	10	3	8	7	7
Critical (15%)	5	5	7	7	6	6	5	6	0	2	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-10-3. Lake Oroville, End of Month Elevation

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance ^a												
10%	788	795	844	849	858	866	887	900	900	866	847	805
20%	760	762	786	837	849	861	884	900	900	860	829	779
30%	742	748	762	813	849	856	882	896	888	846	815	765
40%	716	717	739	776	833	849	877	885	871	827	779	733
50%	697	697	715	751	800	839	858	865	852	804	755	708
60%	687	682	698	740	773	810	836	843	826	765	729	697
70%	679	669	679	704	749	786	805	815	783	723	698	691
80%	668	658	665	685	719	751	773	769	750	696	683	676
90%	650	648	648	668	696	727	749	731	699	679	664	647
Long Term												
Full Simulation Period ^b	711	710	728	758	789	811	831	838	824	783	755	724
Water Year Types ^c												
Wet (32%)	743	748	794	829	852	859	884	897	894	861	836	790
Above Normal (16%)	698	703	722	776	828	856	880	890	879	835	794	746
Below Normal (13%)	730	725	726	751	793	818	838	842	828	773	729	704
Dry (24%)	688	683	686	704	737	775	798	800	775	724	702	684
Critical (15%)	674	667	664	678	693	712	715	712	693	663	648	640

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 5												
Probability of Exceedance ^a												
10%	788	795	847	849	858	866	887	900	900	864	843	798
20%	760	762	787	840	849	861	884	900	900	860	830	779
30%	742	747	763	810	849	856	882	896	888	847	815	765
40%	716	712	735	776	833	849	877	886	872	829	783	736
50%	697	698	720	753	801	839	858	865	853	805	757	710
60%	688	685	698	740	777	812	836	844	830	769	720	697
70%	679	673	679	705	751	787	806	817	788	725	697	689
80%	668	662	667	687	721	753	774	772	754	696	684	673
90%	648	648	649	671	698	727	748	738	704	687	673	658
Long Term												
Full Simulation Period ^b	711	710	729	758	789	812	832	839	826	785	755	724
Water Year Types ^c												
Wet (32%)	742	746	793	829	852	859	884	897	894	860	835	789
Above Normal (16%)	698	701	720	775	827	856	880	891	880	836	795	747
Below Normal (13%)	731	726	728	752	794	818	839	845	831	777	730	704
Dry (24%)	691	685	688	706	738	777	799	804	779	727	703	685
Critical (15%)	676	668	665	679	694	712	716	715	696	667	650	642

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 5 minus No Action Alternative												
Probability of Exceedance ^a												
10%	-1	0	3	0	0	0	0	0	0	-1	-4	-7
20%	0	0	0	3	0	0	0	0	0	0	0	0
30%	0	-1	1	-2	0	0	0	0	0	1	1	1
40%	0	-4	-4	0	0	0	0	1	1	1	4	2
50%	0	1	5	2	1	0	0	0	1	2	2	2
60%	1	3	0	0	4	1	1	2	4	4	-9	0
70%	1	4	0	0	2	1	1	3	5	2	-2	-3
80%	0	4	2	3	2	2	0	3	3	0	1	-3
90%	-3	0	1	3	1	0	-1	7	6	8	10	12
Long Term												
Full Simulation Period ^b	1	0	0	1	1	0	1	2	2	2	1	0
Water Year Types ^c												
Wet (32%)	-1	-1	-1	0	0	0	0	0	0	0	-1	-1
Above Normal (16%)	0	-1	-2	-1	-1	0	0	1	1	1	1	1
Below Normal (13%)	1	1	2	1	1	1	1	2	3	4	1	0
Dry (24%)	3	2	2	2	1	1	1	4	4	3	1	1
Critical (15%)	2	1	1	1	1	0	1	2	3	4	2	2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-10-4. Lake Oroville, End of Month Elevation

Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	837	832	849	850	860	867	887	900	900	866	853	843
20%	811	814	827	849	852	863	884	900	900	861	835	827
30%	776	786	800	833	849	859	882	896	883	848	823	797
40%	752	761	785	820	849	852	877	882	862	820	783	762
50%	719	721	754	802	834	849	868	865	840	798	762	741
60%	685	679	716	754	797	839	856	849	825	774	740	712
70%	672	667	677	704	770	807	831	828	789	758	719	696
80%	666	662	666	680	733	763	782	788	759	720	695	673
90%	651	644	647	667	691	725	736	737	707	683	666	652
Long Term												
Full Simulation Period ^b	730	729	746	771	799	818	838	842	823	788	762	744
Water Year Types^c												
Wet (32%)	768	773	810	837	854	859	884	896	891	861	844	831
Above Normal (16%)	717	723	745	796	838	859	882	888	869	826	790	763
Below Normal (13%)	757	752	757	779	812	834	854	852	823	775	743	719
Dry (24%)	706	701	705	721	755	791	814	813	784	748	718	698
Critical (15%)	677	668	668	680	694	715	716	714	691	664	647	636

No Action Alternative

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	788	795	844	849	858	866	887	900	900	866	847	805
20%	760	762	786	837	849	861	884	900	900	860	829	779
30%	742	748	762	813	849	856	882	896	888	846	815	765
40%	716	717	739	776	833	849	877	885	871	827	779	733
50%	697	697	715	751	800	839	858	865	852	804	755	708
60%	687	682	698	740	773	810	836	843	826	765	729	697
70%	679	669	679	704	749	786	805	815	783	723	698	691
80%	668	658	665	685	719	751	773	769	750	696	683	676
90%	650	648	648	668	696	727	749	731	699	679	664	647
Long Term												
Full Simulation Period ^b	711	710	728	758	789	811	831	838	824	783	755	724
Water Year Types^c												
Wet (32%)	743	748	794	829	852	859	884	897	894	861	836	790
Above Normal (16%)	698	703	722	776	828	856	880	890	879	835	794	746
Below Normal (13%)	730	725	726	751	793	818	838	842	828	773	729	704
Dry (24%)	688	683	686	704	737	775	798	800	775	724	702	684
Critical (15%)	674	667	664	678	693	712	715	712	693	663	648	640

No Action Alternative minus Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-49	-38	-5	-1	-2	-1	0	0	0	0	-7	-38
20%	-51	-52	-40	-12	-3	-2	0	0	0	-1	-6	-48
30%	-34	-39	-37	-20	0	-3	0	0	5	-2	-8	-32
40%	-36	-44	-46	-44	-16	-4	0	3	9	7	-4	-28
50%	-22	-24	-39	-51	-34	-10	-10	-1	12	6	-7	-34
60%	2	2	-18	-14	-24	-29	-20	-6	1	-9	-11	-14
70%	7	2	2	0	-20	-20	-26	-13	-6	-34	-20	-5
80%	2	-4	-1	4	-15	-12	-9	-19	-9	-24	-12	3
90%	-1	3	2	1	5	2	13	-6	-8	-4	-2	-5
Long Term												
Full Simulation Period ^b	-19	-19	-18	-14	-10	-7	-6	-4	1	-5	-8	-21
Water Year Types^c												
Wet (32%)	-24	-25	-16	-8	-3	0	0	1	3	0	-8	-41
Above Normal (16%)	-19	-21	-24	-20	-10	-3	-2	3	10	10	4	-18
Below Normal (13%)	-27	-27	-31	-28	-20	-17	-16	-9	5	-1	-14	-14
Dry (24%)	-18	-18	-18	-17	-18	-16	-15	-14	-9	-24	-17	-15
Critical (15%)	-3	-1	-3	-3	-1	-3	-2	-2	2	0	1	4

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-10-5. Lake Oroville, End of Month Elevation

Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	837	832	849	850	860	867	887	900	900	866	853	843
20%	811	814	827	849	852	863	884	900	900	861	835	827
30%	776	786	800	833	849	859	882	896	883	848	823	797
40%	752	761	785	820	849	852	877	882	862	820	783	762
50%	719	721	754	802	834	849	868	865	840	798	762	741
60%	685	679	716	754	797	839	856	849	825	774	740	712
70%	672	667	677	704	770	807	831	828	789	758	719	696
80%	666	662	666	680	733	763	782	788	759	720	695	673
90%	651	644	647	667	691	725	736	737	707	683	666	652
Long Term												
Full Simulation Period ^b	730	729	746	771	799	818	838	842	823	788	762	744
Water Year Types ^c												
Wet (32%)	768	773	810	837	854	859	884	896	891	861	844	831
Above Normal (16%)	717	723	745	796	838	859	882	888	869	826	790	763
Below Normal (13%)	757	752	757	779	812	834	854	852	823	775	743	719
Dry (24%)	706	701	705	721	755	791	814	813	784	748	718	698
Critical (15%)	677	668	668	680	694	715	716	714	691	664	647	636

Alternative 3

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	839	832	849	850	859	867	887	900	900	866	849	845
20%	793	799	829	849	850	862	884	900	899	856	830	812
30%	773	771	791	826	849	859	882	894	875	833	811	787
40%	745	751	768	811	844	852	877	883	860	815	781	752
50%	699	703	746	794	834	849	869	867	846	794	753	724
60%	691	682	713	750	796	839	855	851	826	769	719	698
70%	680	674	680	710	765	801	831	832	802	741	705	697
80%	670	660	666	686	723	756	786	786	757	709	697	684
90%	652	650	650	669	696	723	748	748	703	687	673	662
Long Term												
Full Simulation Period ^b	727	726	744	770	798	818	838	842	824	783	755	739
Water Year Types ^c												
Wet (32%)	763	767	805	834	853	859	884	895	889	856	836	825
Above Normal (16%)	711	717	738	791	836	859	882	889	872	827	786	758
Below Normal (13%)	758	754	759	781	813	835	854	855	836	780	730	710
Dry (24%)	702	697	703	720	752	789	811	810	779	733	709	691
Critical (15%)	679	671	671	684	699	718	719	718	693	665	648	640

Alternative 3 minus Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	2	0	0	0	0	0	0	0	0	1	-4	1
20%	-18	-15	2	0	-2	0	0	0	-1	-5	-5	-15
30%	-3	-15	-9	-7	0	0	0	-1	-7	-14	-12	-9
40%	-7	-10	-17	-9	-4	0	0	1	-2	-5	-2	-10
50%	-20	-19	-8	-8	-1	0	1	2	6	-4	-9	-17
60%	6	3	-3	-5	-1	0	0	2	1	-5	-21	-14
70%	8	7	4	6	-4	-5	0	5	12	-17	-14	1
80%	4	-2	0	6	-10	-7	4	-2	-3	-11	1	10
90%	1	5	3	2	5	-1	12	11	-4	4	8	10
Long Term												
Full Simulation Period ^b	-3	-3	-2	-1	-1	0	0	0	1	-4	-7	-5
Water Year Types ^c												
Wet (32%)	-5	-6	-4	-2	-1	0	0	0	-2	-5	-8	-6
Above Normal (16%)	-6	-7	-8	-5	-2	1	1	1	3	1	-5	-5
Below Normal (13%)	1	2	2	2	1	1	0	3	13	5	-13	-8
Dry (24%)	-4	-4	-2	-2	-3	-3	-3	-4	-6	-16	-10	-7
Critical (15%)	2	3	3	4	5	3	3	4	2	1	1	4

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-10-6. Lake Oroville, End of Month Elevation

Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	837	832	849	850	860	867	887	900	900	866	853	843
20%	811	814	827	849	852	863	884	900	900	861	835	827
30%	776	786	800	833	849	859	882	896	883	848	823	797
40%	752	761	785	820	849	852	877	882	862	820	783	762
50%	719	721	754	802	834	849	868	865	840	798	762	741
60%	685	679	716	754	797	839	856	849	825	774	740	712
70%	672	667	677	704	770	807	831	828	789	758	719	696
80%	666	662	666	680	733	763	782	788	759	720	695	673
90%	651	644	647	667	691	725	736	737	707	683	666	652
Long Term												
Full Simulation Period ^b	730	729	746	771	799	818	838	842	823	788	762	744
Water Year Types ^c												
Wet (32%)	768	773	810	837	854	859	884	896	891	861	844	831
Above Normal (16%)	717	723	745	796	838	859	882	888	869	826	790	763
Below Normal (13%)	757	752	757	779	812	834	854	852	823	775	743	719
Dry (24%)	706	701	705	721	755	791	814	813	784	748	718	698
Critical (15%)	677	668	668	680	694	715	716	714	691	664	647	636

Alternative 5

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	788	795	847	849	858	866	887	900	900	864	843	798
20%	760	762	787	840	849	861	884	900	900	860	830	779
30%	742	747	763	810	849	856	882	896	888	847	815	765
40%	716	712	735	776	833	849	877	886	872	829	783	736
50%	697	698	720	753	801	839	858	865	853	805	757	710
60%	688	685	698	740	777	812	836	844	830	769	720	697
70%	679	673	679	705	751	787	806	817	788	725	697	689
80%	668	662	667	687	721	753	774	772	754	696	684	673
90%	648	648	649	671	698	727	748	738	704	687	673	658
Long Term												
Full Simulation Period ^b	711	710	729	758	789	812	832	839	826	785	755	724
Water Year Types ^c												
Wet (32%)	742	746	793	829	852	859	884	897	894	860	835	789
Above Normal (16%)	698	701	720	775	827	856	880	891	880	836	795	747
Below Normal (13%)	731	726	728	752	794	818	839	845	831	777	730	704
Dry (24%)	691	685	688	706	738	777	799	804	779	727	703	685
Critical (15%)	676	668	665	679	694	712	716	715	696	667	650	642

Alternative 5 minus Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-49	-38	-2	-1	-2	-1	0	0	0	-1	-10	-45
20%	-51	-52	-40	-9	-3	-2	0	0	0	-1	-6	-48
30%	-34	-40	-37	-23	0	-3	0	0	6	-1	-8	-31
40%	-36	-48	-50	-44	-16	-4	0	4	10	9	1	-26
50%	-22	-24	-34	-49	-33	-10	-10	-1	13	7	-4	-32
60%	3	5	-18	-15	-21	-19	-19	-5	5	-5	-20	-15
70%	8	6	2	0	-18	-19	-25	-11	-2	-32	-22	-8
80%	2	0	1	7	-13	-10	-9	-16	-5	-24	-12	0
90%	-3	3	2	4	6	2	12	0	-2	4	8	7
Long Term												
Full Simulation Period ^b	-18	-19	-17	-13	-9	-7	-6	-2	3	-3	-7	-20
Water Year Types ^c												
Wet (32%)	-26	-26	-16	-7	-3	0	0	1	3	-1	-9	-42
Above Normal (16%)	-19	-22	-25	-21	-11	-3	-2	3	11	10	5	-17
Below Normal (13%)	-26	-26	-29	-27	-19	-16	-15	-7	8	2	-13	-14
Dry (24%)	-15	-16	-16	-16	-17	-15	-14	-9	-5	-22	-15	-13
Critical (15%)	-1	0	-2	-1	-1	-3	-1	1	5	4	3	6

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 C.11. Folsom Lake Elevation

Figure C-11-1 . Folsom Lake, Reservoir Pool Elevation, December

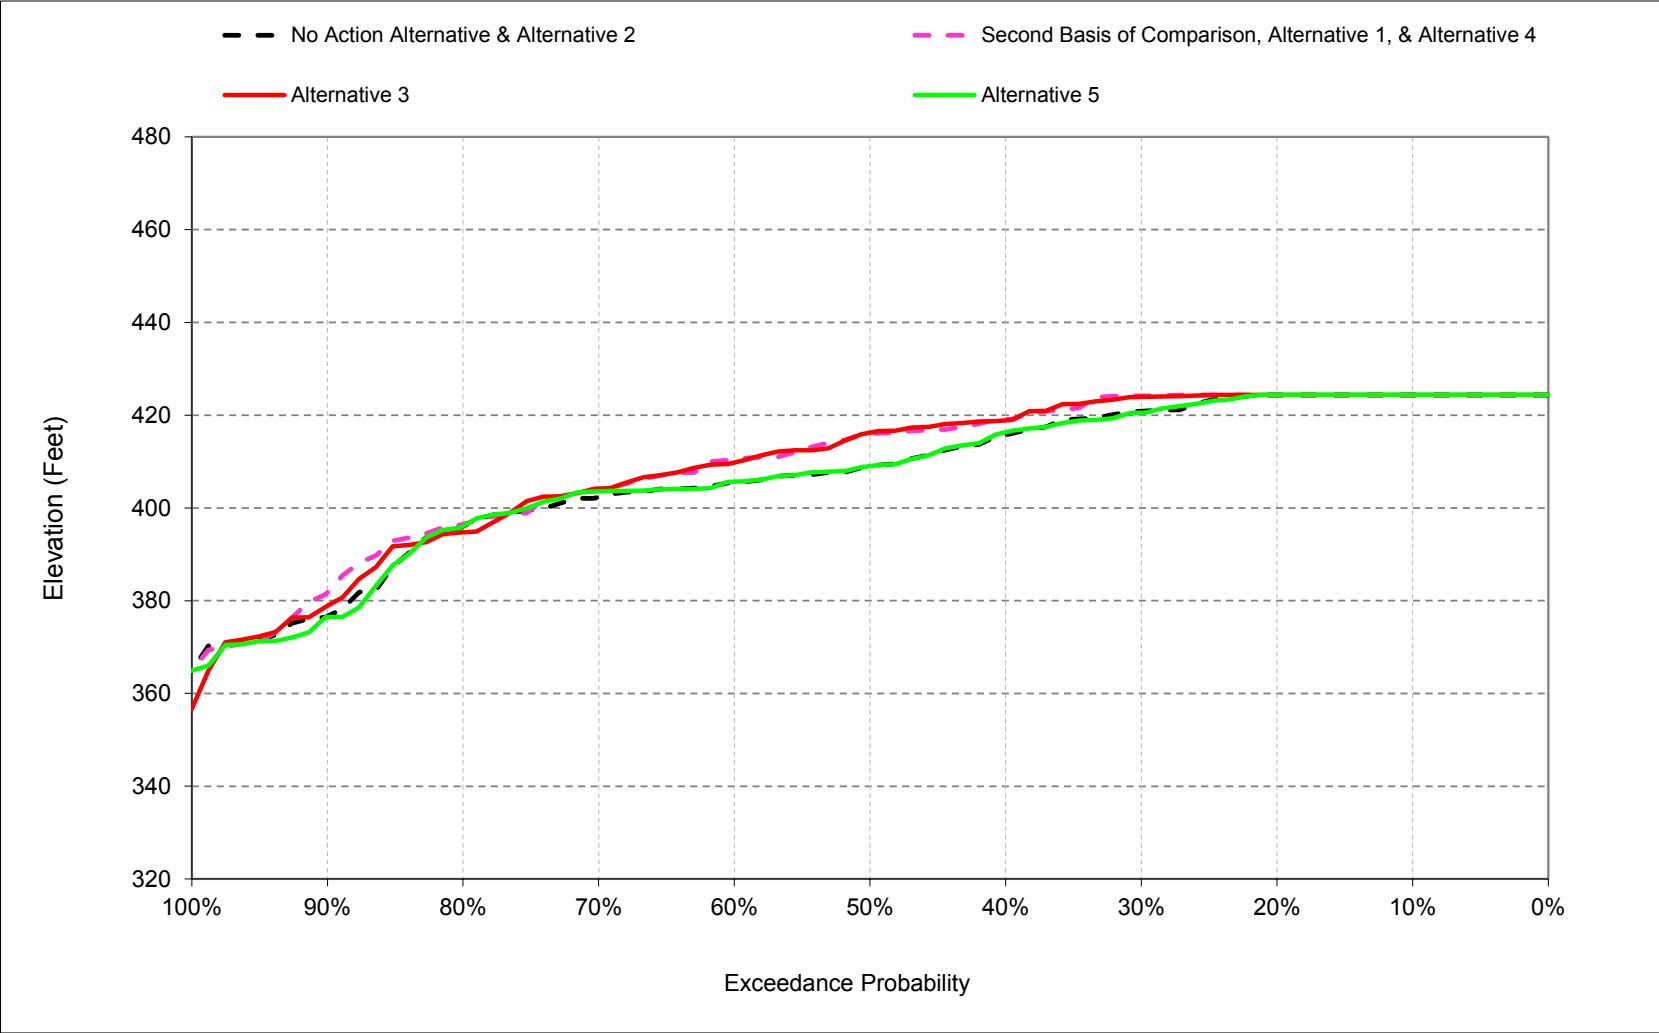


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-11-2. Folsom Lake, Reservoir Pool Elevation, May

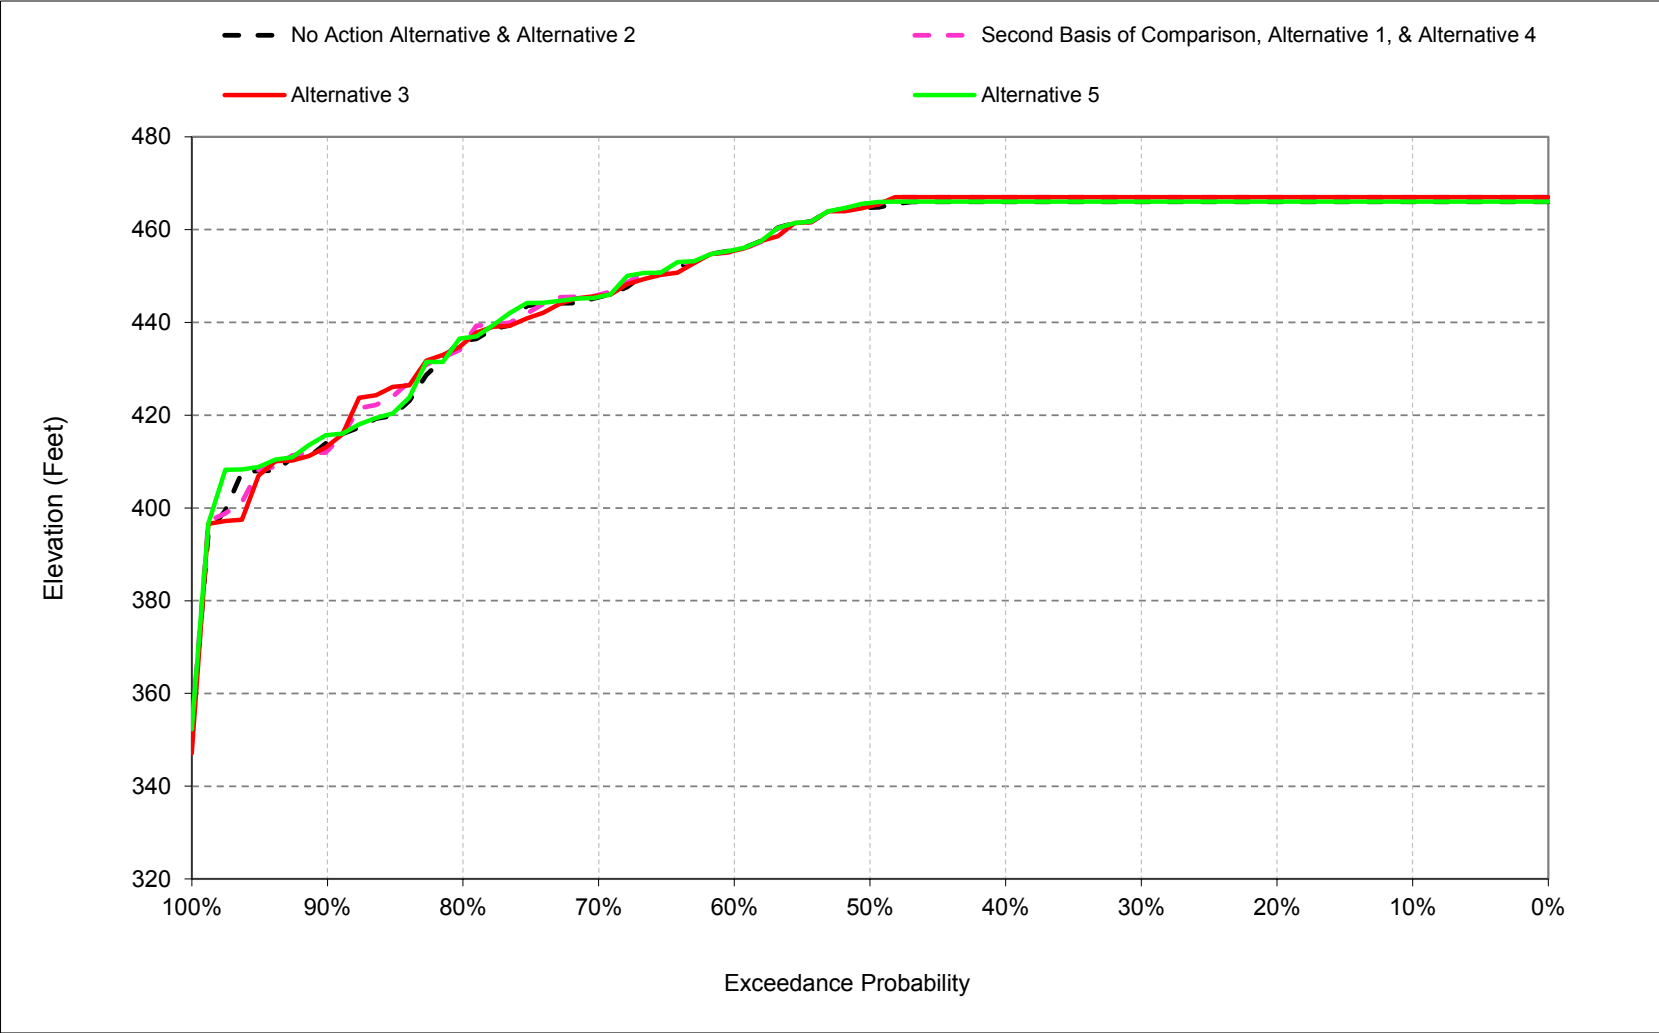

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-11-3. Folsom Lake, Reservoir Pool Elevation, September

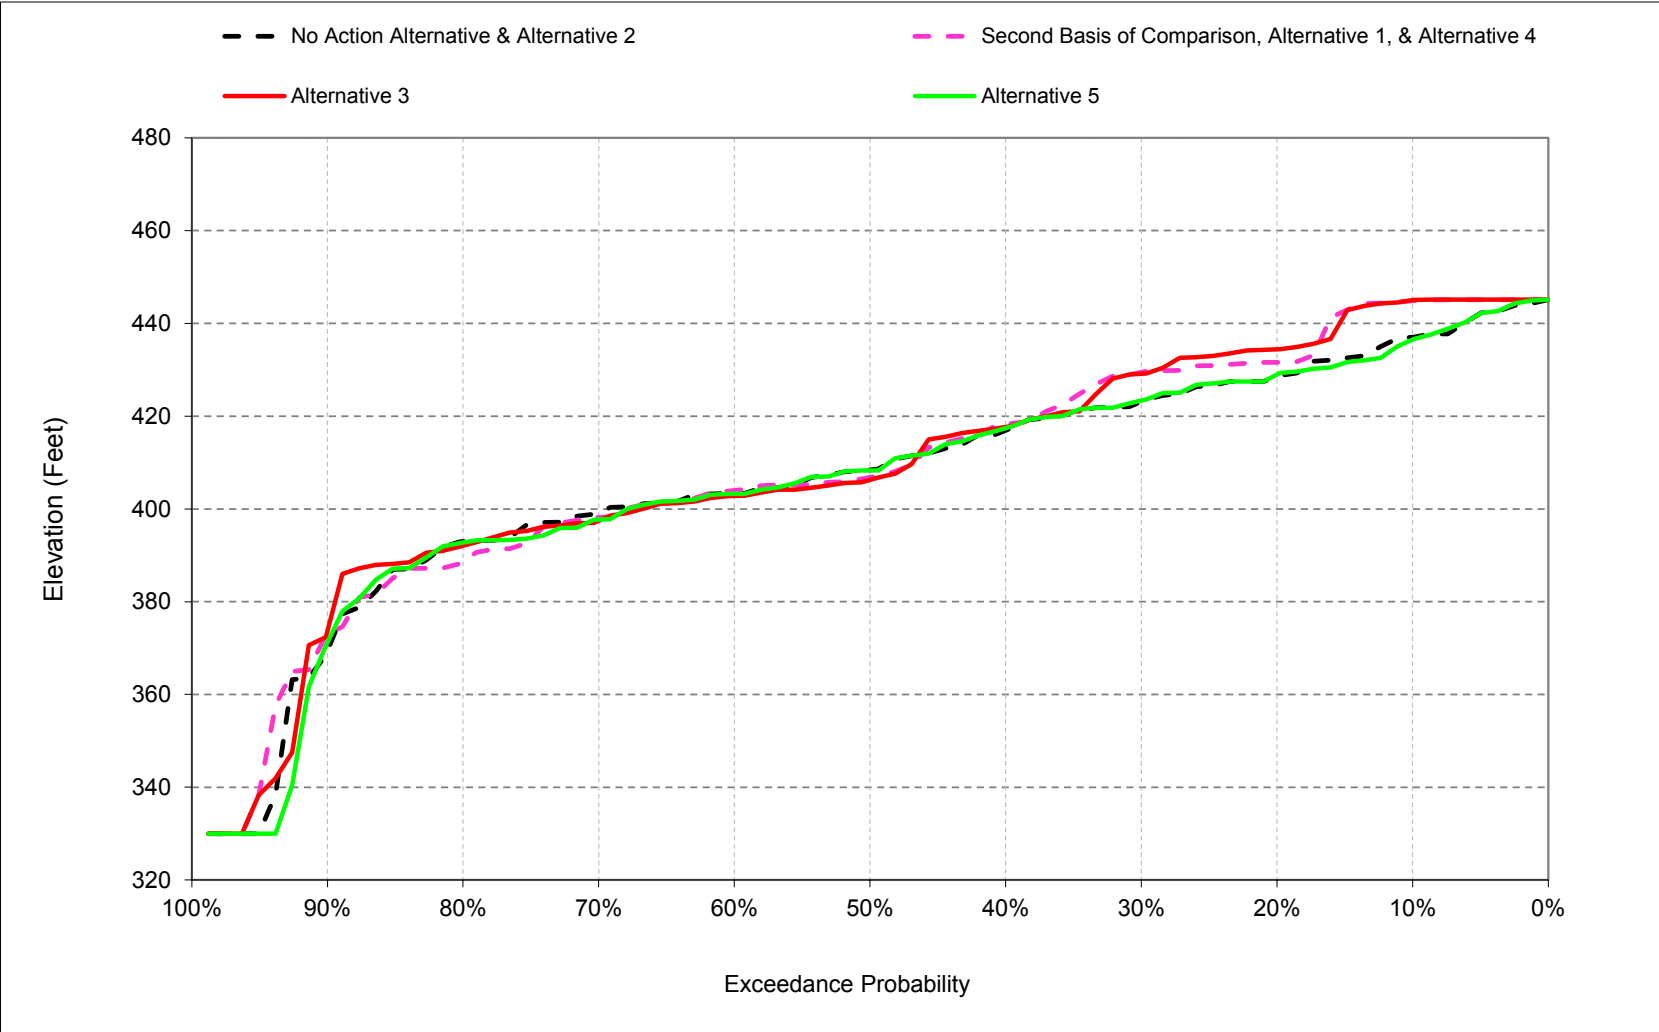

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-11-1. Folsom Lake, End of Month Elevation

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance ^a												
10%	427	420	424	424	424	436	449	466	466	460	449	437
20%	421	415	424	424	424	435	449	466	466	453	443	428
30%	416	411	421	423	423	435	449	466	466	444	438	423
40%	410	407	416	421	423	434	449	466	463	436	429	419
50%	405	404	409	413	420	433	449	465	457	427	418	410
60%	397	403	405	409	415	431	449	456	446	419	410	404
70%	393	397	402	407	411	428	443	445	438	407	401	400
80%	387	389	396	399	405	421	432	436	422	401	397	393
90%	373	378	377	388	402	407	413	414	407	392	385	378
Long Term												
Full Simulation Period ^b	401	400	407	410	414	427	440	450	444	424	416	407
Water Year Types ^c												
Wet (32%)	409	407	418	418	418	432	448	464	464	449	440	425
Above Normal (16%)	394	395	405	418	420	433	449	464	458	430	422	413
Below Normal (13%)	408	406	411	414	420	431	445	454	447	418	411	409
Dry (24%)	400	399	403	405	413	426	438	445	434	414	408	405
Critical (15%)	386	384	389	390	396	406	411	412	401	386	374	366

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 1												
Probability of Exceedance ^a												
10%	439	424	424	424	424	436	449	467	467	460	449	445
20%	426	424	424	424	424	436	449	467	467	451	439	432
30%	423	419	424	424	423	435	449	467	467	443	433	429
40%	412	416	419	423	423	434	449	467	460	434	425	419
50%	404	407	416	419	421	433	449	465	450	422	412	408
60%	396	402	410	412	416	431	449	455	444	417	409	405
70%	394	397	404	407	411	429	443	446	432	408	402	399
80%	386	393	396	402	408	424	433	435	422	400	392	391
90%	379	380	382	390	403	410	415	412	407	389	377	375
Long Term												
Full Simulation Period ^b	404	404	410	412	415	427	440	451	444	423	413	409
Water Year Types ^c												
Wet (32%)	412	412	419	419	418	432	448	465	464	449	438	433
Above Normal (16%)	397	400	410	421	421	433	448	465	456	427	419	414
Below Normal (13%)	415	414	416	417	421	432	446	455	443	410	401	398
Dry (24%)	401	401	405	407	414	427	439	446	435	413	406	403
Critical (15%)	389	386	390	391	397	406	410	411	404	391	378	372

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 1 minus No Action Alternative												
Probability of Exceedance ^a												
10%	12	5	0	0	0	0	0	1	1	0	0	8
20%	6	8	0	0	0	0	0	1	1	-1	-5	3
30%	7	8	3	1	0	0	0	1	1	-1	-5	6
40%	2	9	3	2	0	0	0	1	-2	-3	-5	0
50%	-2	3	7	6	1	0	0	1	-7	-6	-6	-2
60%	0	0	5	3	0	0	0	0	-2	-2	-2	1
70%	1	0	2	1	0	1	0	1	-6	1	1	-2
80%	-1	4	0	3	3	3	1	-1	-1	-1	-5	-2
90%	6	2	5	2	1	3	1	-2	-1	-3	-7	-2
Long Term												
Full Simulation Period ^b	3	4	2	2	1	0	0	1	0	-1	-3	2
Water Year Types ^c												
Wet (32%)	4	5	1	1	0	0	0	1	0	-1	-3	8
Above Normal (16%)	2	5	5	3	1	0	0	1	-3	-4	-4	1
Below Normal (13%)	7	7	4	4	1	1	1	1	-4	-8	-10	-10
Dry (24%)	1	2	2	2	1	1	1	1	1	-1	-1	-1
Critical (15%)	3	2	2	1	0	0	-1	0	2	5	4	6

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-11-2. Folsom Lake, End of Month Elevation

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance ^a												
10%	427	420	424	424	424	436	449	466	466	460	449	437
20%	421	415	424	424	424	435	449	466	466	453	443	428
30%	416	411	421	423	423	435	449	466	466	444	438	423
40%	410	407	416	421	423	434	449	466	463	436	429	419
50%	405	404	409	413	420	433	449	465	457	427	418	410
60%	397	403	405	409	415	431	449	456	446	419	410	404
70%	393	397	402	407	411	428	443	445	438	407	401	400
80%	387	389	396	399	405	421	432	436	422	401	397	393
90%	373	378	377	388	402	407	413	414	407	392	385	378
Long Term												
Full Simulation Period ^b	401	400	407	410	414	427	440	450	444	424	416	407
Water Year Types ^c												
Wet (32%)	409	407	418	418	418	432	448	464	464	449	440	425
Above Normal (16%)	394	395	405	418	420	433	449	464	458	430	422	413
Below Normal (13%)	408	406	411	414	420	431	445	454	447	418	411	409
Dry (24%)	400	399	403	405	413	426	438	445	434	414	408	405
Critical (15%)	386	384	389	390	396	406	411	412	401	386	374	366

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 3												
Probability of Exceedance ^a												
10%	439	424	424	424	424	436	449	467	467	462	449	445
20%	427	424	424	424	424	435	449	467	467	451	441	434
30%	422	421	424	424	423	435	449	467	465	443	434	429
40%	414	415	419	423	423	434	449	467	459	433	424	419
50%	403	408	416	418	422	433	449	465	449	422	412	407
60%	396	402	410	412	416	431	449	455	445	414	408	403
70%	393	397	404	407	411	429	443	446	435	407	401	399
80%	389	393	395	402	408	424	435	435	422	403	395	393
90%	380	381	379	387	402	409	414	413	407	390	385	386
Long Term												
Full Simulation Period ^b	404	404	409	412	415	427	440	451	444	423	414	409
Water Year Types ^c												
Wet (32%)	413	412	419	419	418	432	448	465	463	448	438	433
Above Normal (16%)	395	397	408	421	421	433	448	465	455	425	418	413
Below Normal (13%)	416	415	416	417	421	432	446	454	446	415	404	401
Dry (24%)	401	401	405	407	414	426	438	445	434	414	407	404
Critical (15%)	388	386	390	390	396	406	411	411	403	389	379	372

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 3 minus No Action Alternative												
Probability of Exceedance ^a												
10%	11	5	0	0	0	0	0	1	1	1	0	8
20%	7	9	0	0	0	0	0	1	1	-1	-2	6
30%	6	9	3	1	0	0	0	1	-1	-1	-4	6
40%	4	9	3	2	0	0	0	1	-3	-4	-5	0
50%	-2	3	7	6	2	0	0	0	-8	-6	-6	-2
60%	-1	-1	4	3	0	0	0	0	-1	-4	-3	-1
70%	0	1	2	1	0	1	0	0	-2	1	0	-2
80%	1	4	-1	4	3	3	2	-1	0	1	-2	0
90%	7	2	2	0	0	2	1	-1	0	-3	0	9
Long Term												
Full Simulation Period ^b	3	4	2	2	0	0	0	1	-1	-1	-2	2
Water Year Types ^c												
Wet (32%)	4	5	1	1	0	0	0	1	-1	-1	-3	8
Above Normal (16%)	0	2	3	3	1	0	0	1	-3	-5	-4	0
Below Normal (13%)	8	8	5	4	1	1	1	1	-1	-3	-7	-8
Dry (24%)	1	2	1	1	0	0	0	0	0	-1	-1	-1
Critical (15%)	2	2	1	1	0	0	0	0	2	3	5	6

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-11-3. Folsom Lake, End of Month Elevation

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance ^a												
10%	427	420	424	424	424	436	449	466	466	460	449	437
20%	421	415	424	424	424	435	449	466	466	453	443	428
30%	416	411	421	423	423	435	449	466	466	444	438	423
40%	410	407	416	421	423	434	449	466	463	436	429	419
50%	405	404	409	413	420	433	449	465	457	427	418	410
60%	397	403	405	409	415	431	449	456	446	419	410	404
70%	393	397	402	407	411	428	443	445	438	407	401	400
80%	387	389	396	399	405	421	432	436	422	401	397	393
90%	373	378	377	388	402	407	413	414	407	392	385	378
Long Term												
Full Simulation Period ^b	401	400	407	410	414	427	440	450	444	424	416	407
Water Year Types ^c												
Wet (32%)	409	407	418	418	418	432	448	464	464	449	440	425
Above Normal (16%)	394	395	405	418	420	433	449	464	458	430	422	413
Below Normal (13%)	408	406	411	414	420	431	445	454	447	418	411	409
Dry (24%)	400	399	403	405	413	426	438	445	434	414	408	405
Critical (15%)	386	384	389	390	396	406	411	412	401	386	374	366

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 5												
Probability of Exceedance ^a												
10%	427	420	424	424	424	436	449	466	466	457	449	437
20%	421	415	424	424	424	435	449	466	466	452	443	429
30%	416	411	421	423	423	435	449	466	466	444	436	423
40%	410	407	416	421	423	434	449	466	463	437	429	419
50%	405	405	409	413	420	433	449	466	457	428	418	410
60%	397	403	406	410	415	431	449	456	447	419	411	404
70%	393	397	404	406	410	428	444	446	438	408	402	398
80%	387	390	396	399	405	421	432	437	423	401	396	393
90%	374	378	376	388	401	407	414	416	407	393	385	378
Long Term												
Full Simulation Period ^b	401	400	407	410	414	427	440	451	444	424	415	407
Water Year Types ^c												
Wet (32%)	409	407	418	418	418	432	448	465	464	449	440	425
Above Normal (16%)	394	395	405	418	420	433	449	464	458	431	423	413
Below Normal (13%)	406	405	410	413	420	431	445	454	447	417	411	408
Dry (24%)	400	400	404	406	413	426	438	446	435	413	406	403
Critical (15%)	386	384	389	390	396	406	412	414	400	385	370	365

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 5 minus No Action Alternative												
Probability of Exceedance ^a												
10%	0	0	0	0	0	0	0	0	0	-4	0	-1
20%	0	0	0	0	0	0	0	0	0	-1	0	0
30%	1	0	0	0	0	0	0	0	0	0	-2	0
40%	0	0	1	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	1	0	0	0	0
60%	0	0	0	1	0	0	0	0	1	0	1	0
70%	0	0	1	0	-1	0	0	0	0	1	1	-2
80%	0	1	0	1	0	0	-1	1	0	0	-1	0
90%	0	0	0	0	0	0	1	2	0	0	1	1
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	-1	-1	-1
Water Year Types ^c												
Wet (32%)	0	0	0	0	0	0	0	0	0	-1	0	0
Above Normal (16%)	-1	0	0	0	0	0	0	0	0	0	0	0
Below Normal (13%)	-2	-2	-1	0	0	0	0	0	0	-1	0	0
Dry (24%)	0	0	0	0	0	0	0	1	1	-1	-2	-2
Critical (15%)	0	0	0	0	0	0	1	2	-1	-2	-3	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-11-4. Folsom Lake, End of Month Elevation

Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	439	424	424	424	424	436	449	467	467	460	449	445
20%	426	424	424	424	424	436	449	467	467	451	439	432
30%	423	419	424	424	423	435	449	467	467	443	433	429
40%	412	416	419	423	423	434	449	467	460	434	425	419
50%	404	407	416	419	421	433	449	465	450	422	412	408
60%	396	402	410	412	416	431	449	455	444	417	409	405
70%	394	397	404	407	411	429	443	446	432	408	402	399
80%	386	393	396	402	408	424	433	435	422	400	392	391
90%	379	380	382	390	403	410	415	412	407	389	377	375
Long Term												
Full Simulation Period ^b	404	404	410	412	415	427	440	451	444	423	413	409
Water Year Types ^c												
Wet (32%)	412	412	419	419	418	432	448	465	464	449	438	433
Above Normal (16%)	397	400	410	421	421	433	448	465	456	427	419	414
Below Normal (13%)	415	414	416	417	421	432	446	455	443	410	401	398
Dry (24%)	401	401	405	407	414	427	439	446	435	413	406	403
Critical (15%)	389	386	390	391	397	406	410	411	404	391	378	372

No Action Alternative

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	427	420	424	424	424	436	449	466	466	460	449	437
20%	421	415	424	424	424	435	449	466	466	453	443	428
30%	416	411	421	423	423	435	449	466	466	444	438	423
40%	410	407	416	421	423	434	449	466	463	436	429	419
50%	405	404	409	413	420	433	449	465	457	427	418	410
60%	397	403	405	409	415	431	449	456	446	419	410	404
70%	393	397	402	407	411	428	443	445	438	407	401	400
80%	387	389	396	399	405	421	432	436	422	401	397	393
90%	373	378	377	388	402	407	413	414	407	392	385	378
Long Term												
Full Simulation Period ^b	401	400	407	410	414	427	440	450	444	424	416	407
Water Year Types ^c												
Wet (32%)	409	407	418	418	418	432	448	464	464	449	440	425
Above Normal (16%)	394	395	405	418	420	433	449	464	458	430	422	413
Below Normal (13%)	408	406	411	414	420	431	445	454	447	418	411	409
Dry (24%)	400	399	403	405	413	426	438	445	434	414	408	405
Critical (15%)	386	384	389	390	396	406	411	412	401	386	374	366

No Action Alternative minus Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-12	-5	0	0	0	0	0	-1	-1	0	0	-8
20%	-6	-8	0	0	0	0	0	-1	-1	1	5	-3
30%	-7	-8	-3	-1	0	0	0	-1	-1	1	5	-6
40%	-2	-9	-3	-2	0	0	0	-1	2	3	5	0
50%	2	-3	-7	-6	-1	0	0	-1	7	6	6	2
60%	0	0	-5	-3	0	0	0	0	2	2	2	-1
70%	-1	0	-2	-1	0	-1	0	-1	6	-1	-1	2
80%	1	-4	0	-3	-3	-3	-1	1	1	1	5	2
90%	-6	-2	-5	-2	-1	-3	-1	2	1	3	7	2
Long Term												
Full Simulation Period ^b	-3	-4	-2	-2	-1	0	0	-1	0	1	3	-2
Water Year Types ^c												
Wet (32%)	-4	-5	-1	-1	0	0	0	-1	0	1	3	-8
Above Normal (16%)	-2	-5	-5	-3	-1	0	0	-1	3	4	4	-1
Below Normal (13%)	-7	-7	-4	-4	-1	-1	-1	-1	4	8	10	10
Dry (24%)	-1	-2	-2	-2	-1	-1	-1	-1	1	1	1	1
Critical (15%)	-3	-2	-2	-1	0	0	1	0	-2	-5	-4	-6

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-11-5. Folsom Lake, End of Month Elevation

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	439	424	424	424	424	436	449	467	467	460	449	445
20%	426	424	424	424	424	436	449	467	467	451	439	432
30%	423	419	424	424	423	435	449	467	467	443	433	429
40%	412	416	419	423	423	434	449	467	460	434	425	419
50%	404	407	416	419	421	433	449	465	450	422	412	408
60%	396	402	410	412	416	431	449	455	444	417	409	405
70%	394	397	404	407	411	429	443	446	432	408	402	399
80%	386	393	396	402	408	424	433	435	422	400	392	391
90%	379	380	382	390	403	410	415	412	407	389	377	375
Long Term												
Full Simulation Period ^b	404	404	410	412	415	427	440	451	444	423	413	409
Water Year Types ^c												
Wet (32%)	412	412	419	419	418	432	448	465	464	449	438	433
Above Normal (16%)	397	400	410	421	421	433	448	465	456	427	419	414
Below Normal (13%)	415	414	416	417	421	432	446	455	443	410	401	398
Dry (24%)	401	401	405	407	414	427	439	446	435	413	406	403
Critical (15%)	389	386	390	391	397	406	410	411	404	391	378	372

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 3												
Probability of Exceedance ^a												
10%	439	424	424	424	424	436	449	467	467	462	449	445
20%	427	424	424	424	424	435	449	467	467	451	441	434
30%	422	421	424	424	423	435	449	467	465	443	434	429
40%	414	415	419	423	423	434	449	467	459	433	424	419
50%	403	408	416	418	422	433	449	465	449	422	412	407
60%	396	402	410	412	416	431	449	455	445	414	408	403
70%	393	397	404	407	411	429	443	446	435	407	401	399
80%	389	393	395	402	408	424	435	435	422	403	395	393
90%	380	381	379	387	402	409	414	413	407	390	385	386
Long Term												
Full Simulation Period ^b	404	404	409	412	415	427	440	451	444	423	414	409
Water Year Types ^c												
Wet (32%)	413	412	419	419	418	432	448	465	463	448	438	433
Above Normal (16%)	395	397	408	421	421	433	448	465	455	425	418	413
Below Normal (13%)	416	415	416	417	421	432	446	454	446	415	404	401
Dry (24%)	401	401	405	407	414	426	438	445	434	414	407	404
Critical (15%)	388	386	390	390	396	406	411	411	403	389	379	372

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 3 minus Second Basis of Comparison												
Probability of Exceedance ^a												
10%	0	0	0	0	0	0	0	0	0	1	0	0
20%	1	0	0	0	0	0	0	0	0	0	2	3
30%	-1	1	0	0	0	0	0	0	-1	0	1	0
40%	2	-1	0	0	0	0	0	0	-1	-1	0	0
50%	-1	0	0	0	1	0	0	0	-1	0	0	0
60%	-1	0	-1	0	0	0	0	0	0	-2	-1	-1
70%	-1	0	0	0	0	0	0	0	3	0	-1	0
80%	2	-1	-2	0	0	0	2	0	0	3	4	2
90%	1	0	-3	-2	-1	-1	-1	1	0	1	8	11
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	1	0
Water Year Types ^c												
Wet (32%)	1	1	0	0	0	0	0	0	-1	0	0	0
Above Normal (16%)	-2	-3	-3	0	0	0	0	0	-1	-1	-1	-1
Below Normal (13%)	1	1	0	0	0	0	0	0	3	5	3	3
Dry (24%)	0	0	0	0	-1	-1	-1	-1	-1	1	0	0
Critical (15%)	-1	0	0	0	0	0	0	0	0	-2	1	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-11-6. Folsom Lake, End of Month Elevation

Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	439	424	424	424	424	436	449	467	467	460	449	445
20%	426	424	424	424	424	436	449	467	467	451	439	432
30%	423	419	424	424	423	435	449	467	467	443	433	429
40%	412	416	419	423	423	434	449	467	460	434	425	419
50%	404	407	416	419	421	433	449	465	450	422	412	408
60%	396	402	410	412	416	431	449	455	444	417	409	405
70%	394	397	404	407	411	429	443	446	432	408	402	399
80%	386	393	396	402	408	424	433	435	422	400	392	391
90%	379	380	382	390	403	410	415	412	407	389	377	375
Long Term												
Full Simulation Period ^b	404	404	410	412	415	427	440	451	444	423	413	409
Water Year Types ^c												
Wet (32%)	412	412	419	419	418	432	448	465	464	449	438	433
Above Normal (16%)	397	400	410	421	421	433	448	465	456	427	419	414
Below Normal (13%)	415	414	416	417	421	432	446	455	443	410	401	398
Dry (24%)	401	401	405	407	414	427	439	446	435	413	406	403
Critical (15%)	389	386	390	391	397	406	410	411	404	391	378	372

Alternative 5

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	427	420	424	424	424	436	449	466	466	457	449	437
20%	421	415	424	424	424	435	449	466	466	452	443	429
30%	416	411	421	423	423	435	449	466	466	444	436	423
40%	410	407	416	421	423	434	449	466	463	437	429	419
50%	405	405	409	413	420	433	449	466	457	428	418	410
60%	397	403	406	410	415	431	449	456	447	419	411	404
70%	393	397	404	406	410	428	444	446	438	408	402	398
80%	387	390	396	399	405	421	432	437	423	401	396	393
90%	374	378	376	388	401	407	414	416	407	393	385	378
Long Term												
Full Simulation Period ^b	401	400	407	410	414	427	440	451	444	424	415	407
Water Year Types ^c												
Wet (32%)	409	407	418	418	418	432	448	465	464	449	440	425
Above Normal (16%)	394	395	405	418	420	433	449	464	458	431	423	413
Below Normal (13%)	406	405	410	413	420	431	445	454	447	417	411	408
Dry (24%)	400	400	404	406	413	426	438	446	435	413	406	403
Critical (15%)	386	384	389	390	396	406	412	414	400	385	370	365

Alternative 5 minus Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-12	-4	0	0	0	0	0	-1	-1	-4	0	-8
20%	-6	-9	0	0	0	0	0	-1	-1	0	5	-3
30%	-6	-8	-4	-1	0	0	0	-1	-1	1	3	-6
40%	-2	-9	-3	-2	0	0	0	-1	2	3	5	0
50%	2	-3	-7	-5	-1	0	0	1	7	6	6	2
60%	0	0	-5	-3	0	0	0	0	3	2	2	-1
70%	-1	-1	-1	-1	-1	-1	0	0	6	0	0	0
80%	0	-3	0	-3	-3	-3	-1	2	1	2	4	2
90%	-5	-2	-5	-2	-1	-3	-1	3	1	4	8	3
Long Term												
Full Simulation Period ^b	-3	-4	-3	-2	0	0	0	0	0	1	1	-2
Water Year Types ^c												
Wet (32%)	-4	-5	-1	-1	0	0	0	-1	0	0	3	-8
Above Normal (16%)	-3	-6	-5	-3	-1	0	0	-1	3	4	4	-1
Below Normal (13%)	-9	-9	-6	-4	-1	-1	0	-1	5	7	10	10
Dry (24%)	-1	-1	-1	-2	-1	-1	-1	-1	0	0	0	0
Critical (15%)	-3	-3	-2	-1	0	0	2	2	-3	-6	-8	-7

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 C.12. San Luis Lake Elevation

Figure C-12-1. San Luis Reservoir (SWP and CVP), Reservoir Pool Elevation, May

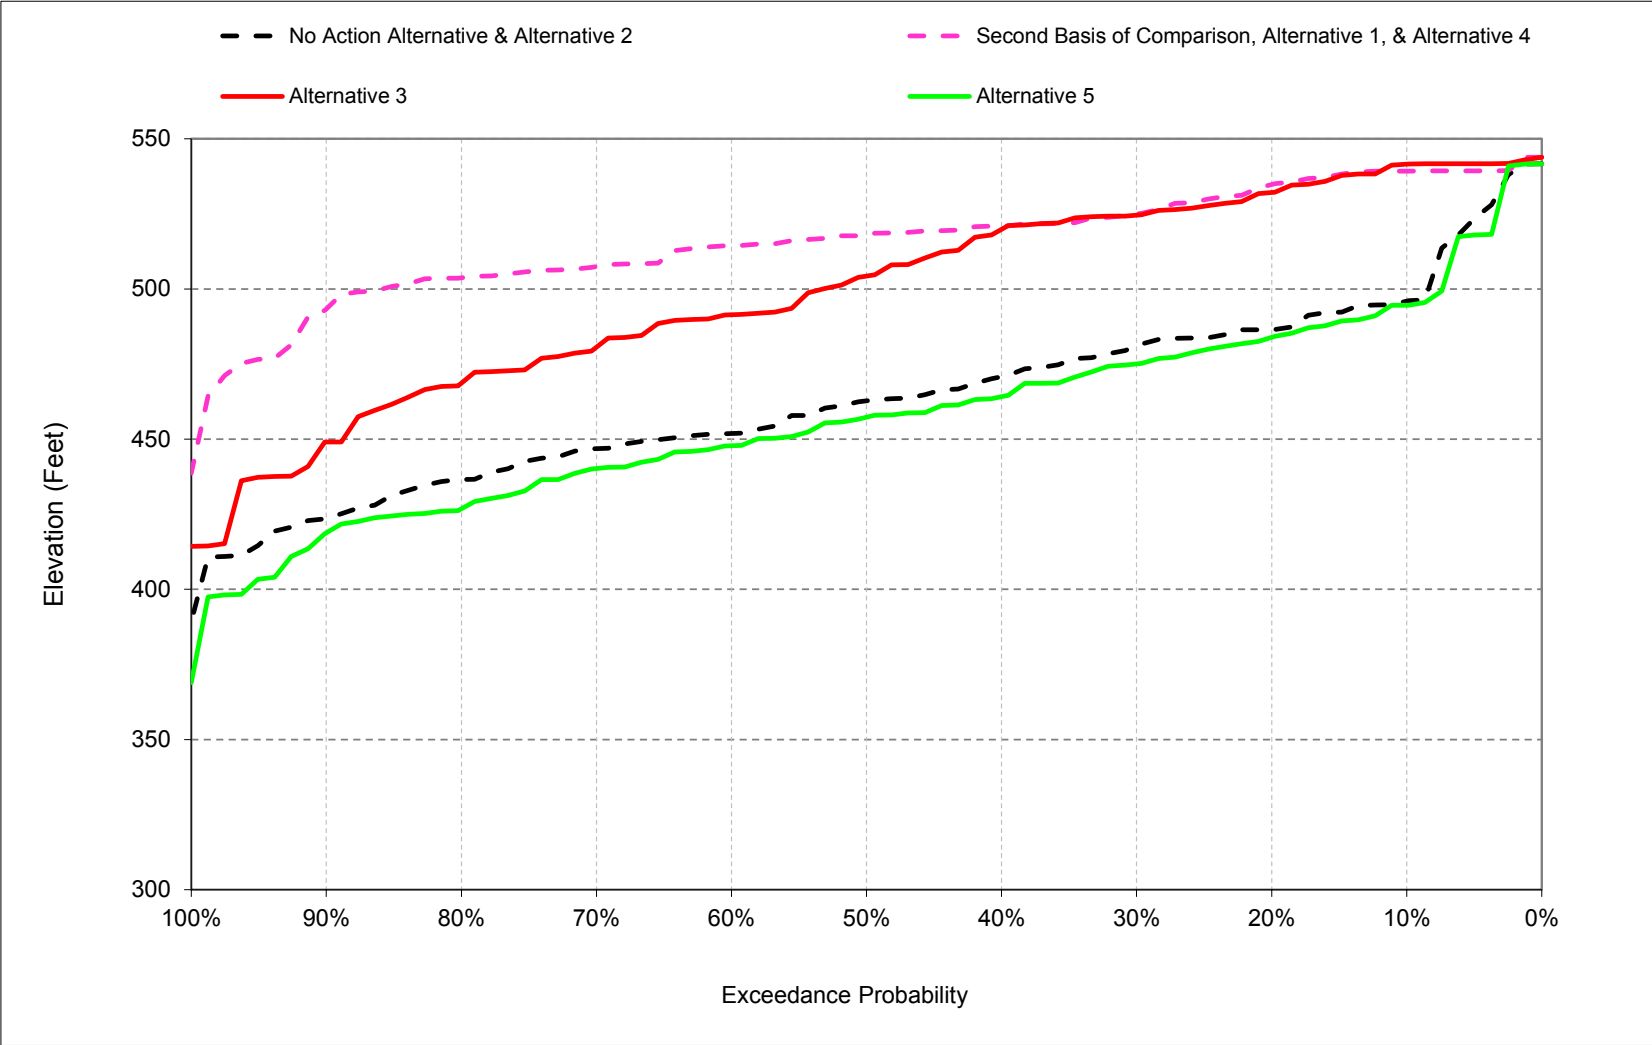

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-12-2. San Luis Reservoir (SWP and CVP), Reservoir Pool Elevation, September

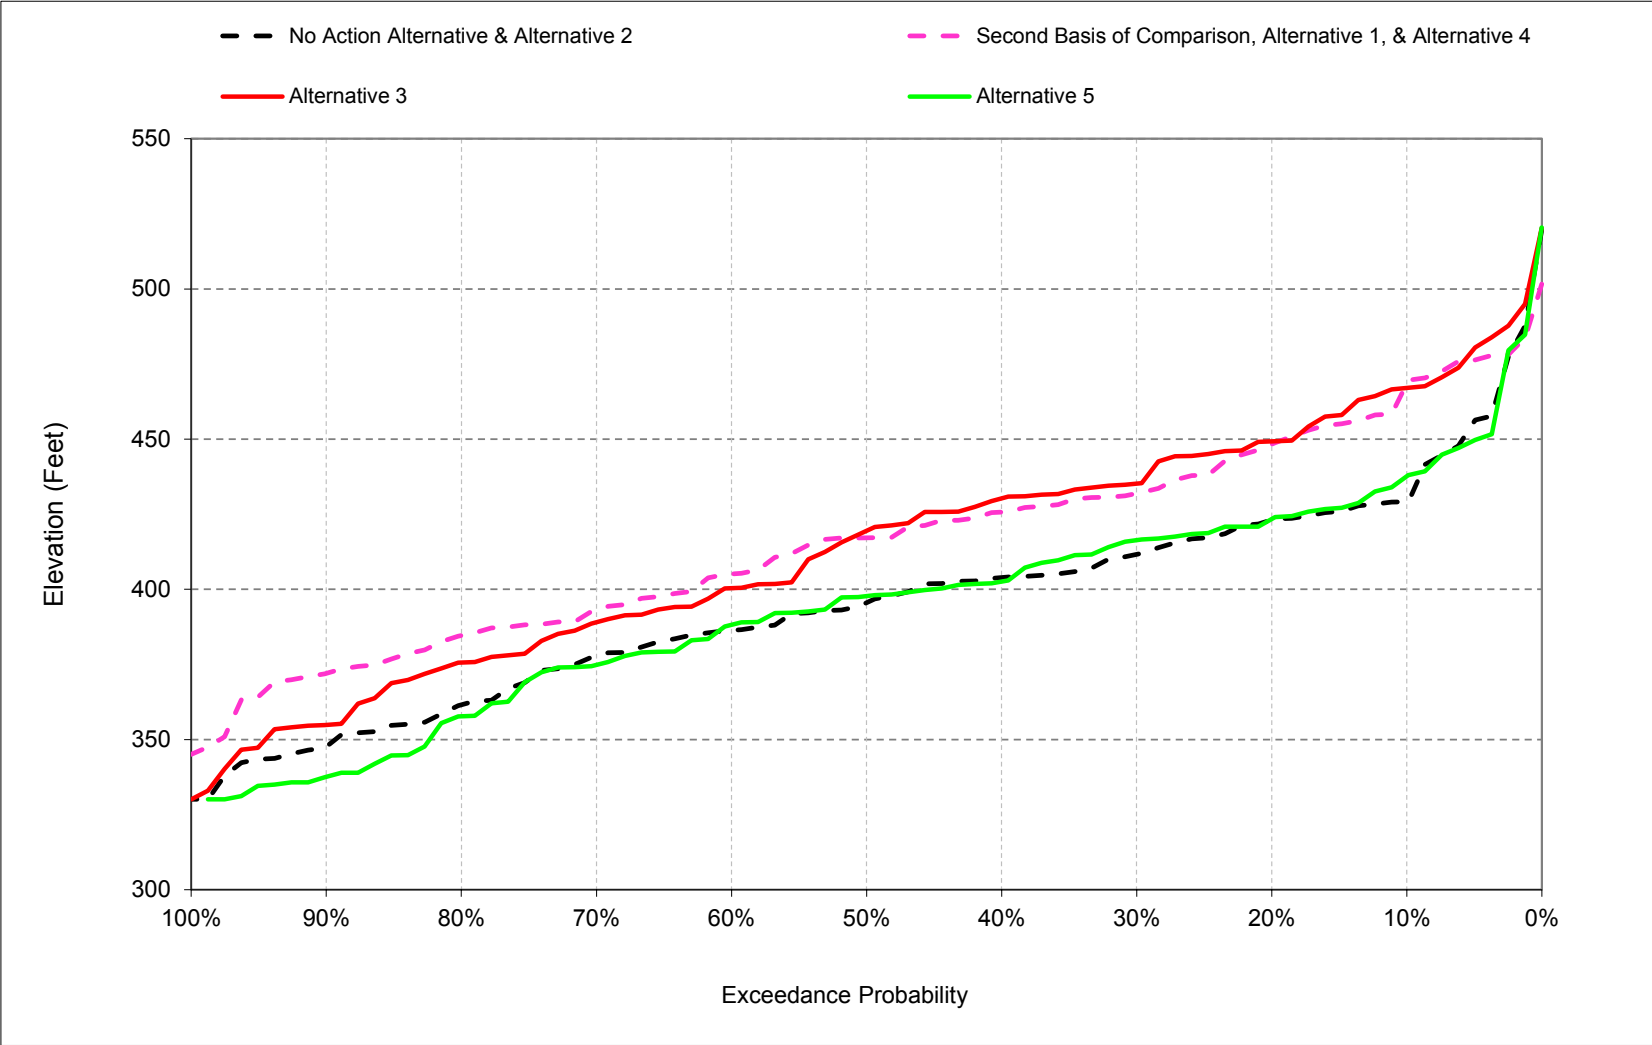

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-12-1. San Luis Reservoir (SWP and CVP), End of Month Elevation

No Action Alternative												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	439	456	483	519	543	544	528	496	469	450	435	429
20%	424	437	468	489	511	533	520	487	455	439	417	423
30%	405	425	460	484	506	525	510	481	444	430	405	412
40%	397	416	451	478	499	518	503	471	432	417	398	404
50%	393	407	434	466	491	510	495	463	422	404	388	396
60%	386	395	426	454	478	500	487	452	417	395	381	386
70%	374	386	421	450	467	482	473	447	410	388	369	378
80%	364	377	409	433	457	478	464	437	397	377	357	362
90%	351	369	392	427	447	461	455	424	380	370	347	348
Long Term												
Full Simulation Period ^b	394	409	439	467	488	504	492	464	428	410	391	395
Water Year Types^c												
Wet (32%)	399	414	443	473	500	523	507	475	444	422	409	416
Above Normal (16%)	391	411	445	472	492	512	493	456	415	389	386	398
Below Normal (13%)	397	410	442	465	481	496	481	448	400	393	383	389
Dry (24%)	391	406	437	466	484	498	490	468	434	426	390	389
Critical (15%)	390	400	423	454	470	475	469	453	422	399	369	366

Alternative 1												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	469	494	519	543	544	544	544	539	520	487	462	468
20%	452	470	503	532	544	544	544	535	504	473	445	448
30%	439	459	491	528	544	544	544	525	497	465	429	432
40%	433	454	478	515	540	544	544	521	486	455	419	426
50%	423	441	467	509	536	544	543	518	481	447	413	417
60%	408	427	459	501	531	544	537	514	476	442	408	405
70%	391	416	450	496	525	539	531	507	473	437	404	393
80%	377	404	438	482	514	530	527	504	468	433	399	385
90%	363	378	416	469	500	518	520	493	459	427	388	372
Long Term												
Full Simulation Period ^b	418	439	468	505	526	536	533	516	484	451	419	416
Water Year Types^c												
Wet (32%)	426	451	485	520	538	543	543	529	497	468	440	443
Above Normal (16%)	412	437	470	513	534	541	540	518	477	437	409	411
Below Normal (13%)	435	457	483	519	533	539	533	510	476	448	412	406
Dry (24%)	407	425	450	492	518	535	530	513	484	453	415	406
Critical (15%)	409	419	441	475	502	512	509	494	468	432	400	389

Alternative 1 minus No Action Alternative												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	30	38	36	24	1	0	16	43	51	38	27	39
20%	28	33	36	42	32	11	24	48	49	34	29	25
30%	34	34	31	44	37	19	34	44	53	35	24	20
40%	36	38	28	37	41	26	41	50	54	38	21	22
50%	30	35	33	43	44	34	47	55	59	42	25	22
60%	22	32	33	46	53	44	50	63	60	47	27	19
70%	18	30	29	47	58	56	58	61	63	50	35	15
80%	12	27	29	49	57	52	63	67	72	57	42	23
90%	12	9	24	43	53	57	65	70	79	57	41	24
Long Term												
Full Simulation Period ^b	24	30	29	38	38	31	41	52	56	41	28	21
Water Year Types^c												
Wet (32%)	26	37	42	46	38	20	36	53	53	46	30	27
Above Normal (16%)	21	26	25	41	41	29	47	61	62	48	23	14
Below Normal (13%)	38	47	42	54	52	43	52	62	76	56	30	17
Dry (24%)	17	19	12	25	34	37	40	45	51	27	25	18
Critical (15%)	19	20	18	21	32	38	40	41	45	32	32	24

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-12-2. San Luis Reservoir (SWP and CVP), End of Month Elevation

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance ^a												
10%	439	456	483	519	543	544	528	496	469	450	435	429
20%	424	437	468	489	511	533	520	487	455	439	417	423
30%	405	425	460	484	506	525	510	481	444	430	405	412
40%	397	416	451	478	499	518	503	471	432	417	398	404
50%	393	407	434	466	491	510	495	463	422	404	388	396
60%	386	395	426	454	478	500	487	452	417	395	381	386
70%	374	386	421	450	467	482	473	447	410	388	369	378
80%	364	377	409	433	457	478	464	437	397	377	357	362
90%	351	369	392	427	447	461	455	424	380	370	347	348
Long Term												
Full Simulation Period ^b	394	409	439	467	488	504	492	464	428	410	391	395
Water Year Types ^c												
Wet (32%)	399	414	443	473	500	523	507	475	444	422	409	416
Above Normal (16%)	391	411	445	472	492	512	493	456	415	389	386	398
Below Normal (13%)	397	410	442	465	481	496	481	448	400	393	383	389
Dry (24%)	391	406	437	466	484	498	490	468	434	426	390	389
Critical (15%)	390	400	423	454	470	475	469	453	422	399	369	366

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 3												
Probability of Exceedance ^a												
10%	475	494	514	532	544	544	544	542	515	493	465	467
20%	451	475	494	517	537	544	544	532	503	477	450	449
30%	442	459	483	506	527	543	541	525	491	465	440	435
40%	432	451	477	498	516	533	538	520	484	451	423	430
50%	423	439	465	489	509	526	522	504	468	444	418	419
60%	402	428	455	482	499	517	514	491	457	432	408	400
70%	380	417	445	473	494	508	503	481	449	421	393	389
80%	372	396	429	459	479	491	490	469	436	408	382	376
90%	356	377	410	439	453	469	471	449	411	392	366	355
Long Term												
Full Simulation Period ^b	416	437	463	487	504	516	515	499	469	443	416	414
Water Year Types ^c												
Wet (32%)	427	452	477	503	525	537	539	529	502	473	447	449
Above Normal (16%)	406	431	459	482	504	520	521	505	467	433	417	420
Below Normal (13%)	431	454	480	497	509	519	512	484	440	423	405	401
Dry (24%)	410	430	456	480	494	508	506	490	464	444	405	397
Critical (15%)	399	409	430	458	472	475	473	457	434	403	375	371

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 3 minus No Action Alternative												
Probability of Exceedance ^a												
10%	36	38	31	13	1	0	16	46	46	43	30	38
20%	27	38	27	28	26	11	24	46	48	38	34	26
30%	38	34	23	22	20	19	32	44	47	36	35	24
40%	35	34	26	20	17	15	35	49	52	34	25	26
50%	30	32	31	23	17	16	27	42	46	40	30	24
60%	16	34	30	28	21	17	27	40	40	37	27	14
70%	6	31	24	23	26	25	30	34	39	34	24	11
80%	7	19	20	26	22	13	26	32	39	31	24	14
90%	5	8	18	13	7	8	16	25	31	22	19	7
Long Term												
Full Simulation Period ^b	22	28	24	19	16	11	23	36	41	32	25	19
Water Year Types ^c												
Wet (32%)	28	38	34	29	24	14	32	53	58	52	38	33
Above Normal (16%)	14	21	15	11	11	8	28	49	51	44	31	23
Below Normal (13%)	33	44	39	32	28	23	30	36	40	30	23	12
Dry (24%)	19	24	18	14	10	10	16	23	30	18	15	9
Critical (15%)	9	10	6	4	2	1	4	4	12	4	6	5

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-12-3. San Luis Reservoir (SWP and CVP), End of Month Elevation

No Action Alternative												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	439	456	483	519	543	544	528	496	469	450	435	429
20%	424	437	468	489	511	533	520	487	455	439	417	423
30%	405	425	460	484	506	525	510	481	444	430	405	412
40%	397	416	451	478	499	518	503	471	432	417	398	404
50%	393	407	434	466	491	510	495	463	422	404	388	396
60%	386	395	426	454	478	500	487	452	417	395	381	386
70%	374	386	421	450	467	482	473	447	410	388	369	378
80%	364	377	409	433	457	478	464	437	397	377	357	362
90%	351	369	392	427	447	461	455	424	380	370	347	348
Long Term												
Full Simulation Period ^b	394	409	439	467	488	504	492	464	428	410	391	395
Water Year Types^c												
Wet (32%)	399	414	443	473	500	523	507	475	444	422	409	416
Above Normal (16%)	391	411	445	472	492	512	493	456	415	389	386	398
Below Normal (13%)	397	410	442	465	481	496	481	448	400	393	383	389
Dry (24%)	391	406	437	466	484	498	490	468	434	426	390	389
Critical (15%)	390	400	423	454	470	475	469	453	422	399	369	366

Alternative 5												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	436	451	482	507	541	544	526	495	473	450	433	438
20%	422	440	466	491	513	534	519	484	454	440	424	423
30%	410	425	457	484	507	527	509	475	440	427	408	416
40%	402	416	452	475	499	518	500	464	423	411	395	403
50%	395	408	440	466	490	509	492	457	419	402	386	398
60%	385	398	426	457	480	498	481	448	412	390	379	388
70%	371	386	421	450	469	489	472	440	400	383	368	375
80%	363	376	408	435	459	479	464	427	389	371	353	358
90%	348	361	391	428	446	457	445	419	377	363	340	338
Long Term												
Full Simulation Period ^b	394	408	438	467	488	504	489	457	422	406	390	394
Water Year Types^c												
Wet (32%)	402	417	446	475	501	525	509	478	448	427	416	422
Above Normal (16%)	391	408	443	471	492	512	494	456	416	390	386	398
Below Normal (13%)	399	411	443	467	483	498	481	444	397	390	381	388
Dry (24%)	389	404	436	465	483	497	482	451	417	413	381	381
Critical (15%)	383	393	417	450	467	471	460	437	405	383	359	357

Alternative 5 minus No Action Alternative												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-3	-5	-1	-11	-2	0	-1	-1	5	0	-2	8
20%	-2	3	-2	1	1	2	-1	-3	-1	1	7	0
30%	6	0	-3	1	1	2	-1	-6	-4	-3	2	5
40%	5	-1	1	-3	-1	1	-3	-7	-9	-7	-3	-1
50%	2	1	7	0	-1	-1	-4	-5	-3	-2	-2	2
60%	0	4	0	3	2	-1	-5	-4	-5	-5	-2	2
70%	-3	0	1	1	2	6	-1	-7	-10	-5	-1	-3
80%	-2	-1	-1	3	2	1	0	-10	-7	-6	-4	-4
90%	-3	-7	-1	1	-1	-4	-10	-5	-3	-7	-6	-10
Long Term												
Full Simulation Period ^b	0	-1	0	0	0	0	-3	-6	-6	-4	-2	-1
Water Year Types^c												
Wet (32%)	3	3	3	1	1	1	2	3	4	5	6	6
Above Normal (16%)	0	-3	-2	-1	0	0	0	0	1	1	1	1
Below Normal (13%)	2	1	2	2	2	2	-1	-4	-3	-3	-2	-1
Dry (24%)	-2	-2	-1	-1	-1	-1	-8	-16	-17	-13	-9	-7
Critical (15%)	-7	-7	-6	-4	-3	-3	-9	-16	-18	-16	-10	-9

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-12-4. San Luis Reservoir (SWP and CVP), End of Month Elevation

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance^a												
10%	469	494	519	543	544	544	544	539	520	487	462	468
20%	452	470	503	532	544	544	544	535	504	473	445	448
30%	439	459	491	528	544	544	544	525	497	465	429	432
40%	433	454	478	515	540	544	544	521	486	455	419	426
50%	423	441	467	509	536	544	543	518	481	447	413	417
60%	408	427	459	501	531	544	537	514	476	442	408	405
70%	391	416	450	496	525	539	531	507	473	437	404	393
80%	377	404	438	482	514	530	527	504	468	433	399	385
90%	363	378	416	469	500	518	520	493	459	427	388	372
Long Term												
Full Simulation Period ^b	418	439	468	505	526	536	533	516	484	451	419	416
Water Year Types^c												
Wet (32%)	426	451	485	520	538	543	543	529	497	468	440	443
Above Normal (16%)	412	437	470	513	534	541	540	518	477	437	409	411
Below Normal (13%)	435	457	483	519	533	539	533	510	476	448	412	406
Dry (24%)	407	425	450	492	518	535	530	513	484	453	415	406
Critical (15%)	409	419	441	475	502	512	509	494	468	432	400	389

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance^a												
10%	439	456	483	519	543	544	528	496	469	450	435	429
20%	424	437	468	489	511	533	520	487	455	439	417	423
30%	405	425	460	484	506	525	510	481	444	430	405	412
40%	397	416	451	478	499	518	503	471	432	417	398	404
50%	393	407	434	466	491	510	495	463	422	404	388	396
60%	386	395	426	454	478	500	487	452	417	395	381	386
70%	374	386	421	450	467	482	473	447	410	388	369	378
80%	364	377	409	433	457	478	464	437	397	377	357	362
90%	351	369	392	427	447	461	455	424	380	370	347	348
Long Term												
Full Simulation Period ^b	394	409	439	467	488	504	492	464	428	410	391	395
Water Year Types^c												
Wet (32%)	399	414	443	473	500	523	507	475	444	422	409	416
Above Normal (16%)	391	411	445	472	492	512	493	456	415	389	386	398
Below Normal (13%)	397	410	442	465	481	496	481	448	400	393	383	389
Dry (24%)	391	406	437	466	484	498	490	468	434	426	390	389
Critical (15%)	390	400	423	454	470	475	469	453	422	399	369	366

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative minus Second Basis of Comparison												
Probability of Exceedance^a												
10%	-30	-38	-36	-24	-1	0	-16	-43	-51	-38	-27	-39
20%	-28	-33	-36	-42	-32	-11	-24	-48	-49	-34	-29	-25
30%	-34	-34	-31	-44	-37	-19	-34	-44	-53	-35	-24	-20
40%	-36	-38	-28	-37	-41	-26	-41	-50	-54	-38	-21	-22
50%	-30	-35	-33	-43	-44	-34	-47	-55	-59	-42	-25	-22
60%	-22	-32	-33	-46	-53	-44	-50	-63	-60	-47	-27	-19
70%	-18	-30	-29	-47	-58	-56	-58	-61	-63	-50	-35	-15
80%	-12	-27	-29	-49	-57	-52	-63	-67	-72	-57	-42	-23
90%	-12	-9	-24	-43	-53	-57	-65	-70	-79	-57	-41	-24
Long Term												
Full Simulation Period ^b	-24	-30	-29	-38	-38	-31	-41	-52	-56	-41	-28	-21
Water Year Types^c												
Wet (32%)	-26	-37	-42	-46	-38	-20	-36	-53	-53	-46	-30	-27
Above Normal (16%)	-21	-26	-25	-41	-41	-29	-47	-61	-62	-48	-23	-14
Below Normal (13%)	-38	-47	-42	-54	-52	-43	-52	-62	-76	-56	-30	-17
Dry (24%)	-17	-19	-12	-25	-34	-37	-40	-45	-51	-27	-25	-18
Critical (15%)	-19	-20	-18	-21	-32	-38	-40	-41	-45	-32	-32	-24

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-12-5. San Luis Reservoir (SWP and CVP), End of Month Elevation

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	469	494	519	543	544	544	544	539	520	487	462	468
20%	452	470	503	532	544	544	544	535	504	473	445	448
30%	439	459	491	528	544	544	544	525	497	465	429	432
40%	433	454	478	515	540	544	544	521	486	455	419	426
50%	423	441	467	509	536	544	543	518	481	447	413	417
60%	408	427	459	501	531	544	537	514	476	442	408	405
70%	391	416	450	496	525	539	531	507	473	437	404	393
80%	377	404	438	482	514	530	527	504	468	433	399	385
90%	363	378	416	469	500	518	520	493	459	427	388	372
Long Term												
Full Simulation Period ^b	418	439	468	505	526	536	533	516	484	451	419	416
Water Year Types ^c												
Wet (32%)	426	451	485	520	538	543	543	529	497	468	440	443
Above Normal (16%)	412	437	470	513	534	541	540	518	477	437	409	411
Below Normal (13%)	435	457	483	519	533	539	533	510	476	448	412	406
Dry (24%)	407	425	450	492	518	535	530	513	484	453	415	406
Critical (15%)	409	419	441	475	502	512	509	494	468	432	400	389

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 3												
Probability of Exceedance ^a												
10%	475	494	514	532	544	544	544	542	515	493	465	467
20%	451	475	494	517	537	544	544	532	503	477	450	449
30%	442	459	483	506	527	543	541	525	491	465	440	435
40%	432	451	477	498	516	533	538	520	484	451	423	430
50%	423	439	465	489	509	526	522	504	468	444	418	419
60%	402	428	455	482	499	517	514	491	457	432	408	400
70%	380	417	445	473	494	508	503	481	449	421	393	389
80%	372	396	429	459	479	491	490	469	436	408	382	376
90%	356	377	410	439	453	469	471	449	411	392	366	355
Long Term												
Full Simulation Period ^b	416	437	463	487	504	516	515	499	469	443	416	414
Water Year Types ^c												
Wet (32%)	427	452	477	503	525	537	539	529	502	473	447	449
Above Normal (16%)	406	431	459	482	504	520	521	505	467	433	417	420
Below Normal (13%)	431	454	480	497	509	519	512	484	440	423	405	401
Dry (24%)	410	430	456	480	494	508	506	490	464	444	405	397
Critical (15%)	399	409	430	458	472	475	473	457	434	403	375	371

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 3 minus Second Basis of Comparison												
Probability of Exceedance ^a												
10%	6	0	-4	-11	0	0	0	2	-5	5	3	-1
20%	-1	5	-9	-14	-7	0	0	-3	-1	4	5	1
30%	4	0	-8	-22	-17	0	-3	0	-6	1	11	3
40%	-1	-3	-2	-17	-24	-11	-6	-1	-2	-4	4	5
50%	1	-2	-3	-20	-27	-18	-20	-14	-13	-2	5	2
60%	-6	2	-4	-18	-32	-27	-23	-23	-20	-10	0	-5
70%	-12	1	-5	-24	-31	-31	-28	-27	-24	-16	-11	-4
80%	-5	-8	-9	-23	-35	-39	-37	-35	-33	-26	-18	-9
90%	-7	-1	-6	-30	-47	-49	-49	-44	-48	-35	-22	-17
Long Term												
Full Simulation Period ^b	-2	-1	-5	-18	-22	-20	-19	-17	-15	-9	-3	-2
Water Year Types ^c												
Wet (32%)	1	1	-8	-17	-13	-6	-5	0	5	6	8	6
Above Normal (16%)	-7	-6	-11	-31	-30	-21	-20	-13	-11	-4	8	9
Below Normal (13%)	-4	-3	-3	-22	-24	-20	-22	-26	-36	-26	-7	-4
Dry (24%)	3	5	6	-11	-24	-27	-24	-23	-21	-9	-9	-9
Critical (15%)	-10	-10	-12	-17	-30	-37	-36	-36	-34	-28	-25	-19

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-12-6. San Luis Reservoir (SWP and CVP), End of Month Elevation

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance^a												
10%	469	494	519	543	544	544	544	539	520	487	462	468
20%	452	470	503	532	544	544	544	535	504	473	445	448
30%	439	459	491	528	544	544	544	525	497	465	429	432
40%	433	454	478	515	540	544	544	521	486	455	419	426
50%	423	441	467	509	536	544	543	518	481	447	413	417
60%	408	427	459	501	531	544	537	514	476	442	408	405
70%	391	416	450	496	525	539	531	507	473	437	404	393
80%	377	404	438	482	514	530	527	504	468	433	399	385
90%	363	378	416	469	500	518	520	493	459	427	388	372
Long Term												
Full Simulation Period ^b	418	439	468	505	526	536	533	516	484	451	419	416
Water Year Types^c												
Wet (32%)	426	451	485	520	538	543	543	529	497	468	440	443
Above Normal (16%)	412	437	470	513	534	541	540	518	477	437	409	411
Below Normal (13%)	435	457	483	519	533	539	533	510	476	448	412	406
Dry (24%)	407	425	450	492	518	535	530	513	484	453	415	406
Critical (15%)	409	419	441	475	502	512	509	494	468	432	400	389


Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 5												
Probability of Exceedance^a												
10%	436	451	482	507	541	544	526	495	473	450	433	438
20%	422	440	466	491	513	534	519	484	454	440	424	423
30%	410	425	457	484	507	527	509	475	440	427	408	416
40%	402	416	452	475	499	518	500	464	423	411	395	403
50%	395	408	440	466	490	509	492	457	419	402	386	398
60%	385	398	426	457	480	498	481	448	412	390	379	388
70%	371	386	421	450	469	489	472	440	400	383	368	375
80%	363	376	408	435	459	479	464	427	389	371	353	358
90%	348	361	391	428	446	457	445	419	377	363	340	338
Long Term												
Full Simulation Period ^b	394	408	438	467	488	504	489	457	422	406	390	394
Water Year Types^c												
Wet (32%)	402	417	446	475	501	525	509	478	448	427	416	422
Above Normal (16%)	391	408	443	471	492	512	494	456	416	390	386	398
Below Normal (13%)	399	411	443	467	483	498	481	444	397	390	381	388
Dry (24%)	389	404	436	465	483	497	482	451	417	413	381	381
Critical (15%)	383	393	417	450	467	471	460	437	405	383	359	357

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 5 minus Second Basis of Comparison												
Probability of Exceedance^a												
10%	-34	-43	-37	-36	-3	0	-17	-45	-46	-37	-30	-31
20%	-30	-30	-37	-41	-31	-9	-25	-51	-50	-33	-21	-25
30%	-28	-34	-34	-43	-36	-17	-35	-50	-57	-38	-22	-16
40%	-31	-38	-26	-40	-42	-26	-44	-57	-63	-45	-24	-23
50%	-28	-33	-27	-43	-45	-35	-51	-61	-62	-44	-27	-19
60%	-22	-28	-33	-44	-51	-46	-56	-67	-65	-52	-29	-17
70%	-20	-30	-28	-46	-56	-50	-59	-67	-73	-54	-36	-18
80%	-14	-28	-30	-47	-55	-51	-63	-77	-79	-63	-46	-27
90%	-15	-17	-25	-42	-54	-61	-75	-75	-82	-64	-47	-35
Long Term												
Full Simulation Period ^b	-24	-30	-29	-38	-39	-31	-44	-58	-62	-45	-30	-22
Water Year Types^c												
Wet (32%)	-24	-34	-40	-45	-36	-19	-34	-51	-49	-41	-24	-22
Above Normal (16%)	-21	-29	-28	-42	-41	-29	-47	-62	-61	-47	-23	-13
Below Normal (13%)	-36	-46	-40	-53	-50	-41	-53	-66	-80	-58	-31	-17
Dry (24%)	-18	-21	-14	-26	-35	-38	-48	-62	-68	-39	-34	-25
Critical (15%)	-26	-26	-24	-26	-36	-41	-49	-57	-63	-48	-42	-33

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 **C.13. New Melones Lake Elevation**

Figure C-13-1. New Melones Reservoir, Reservoir Pool Elevation, May

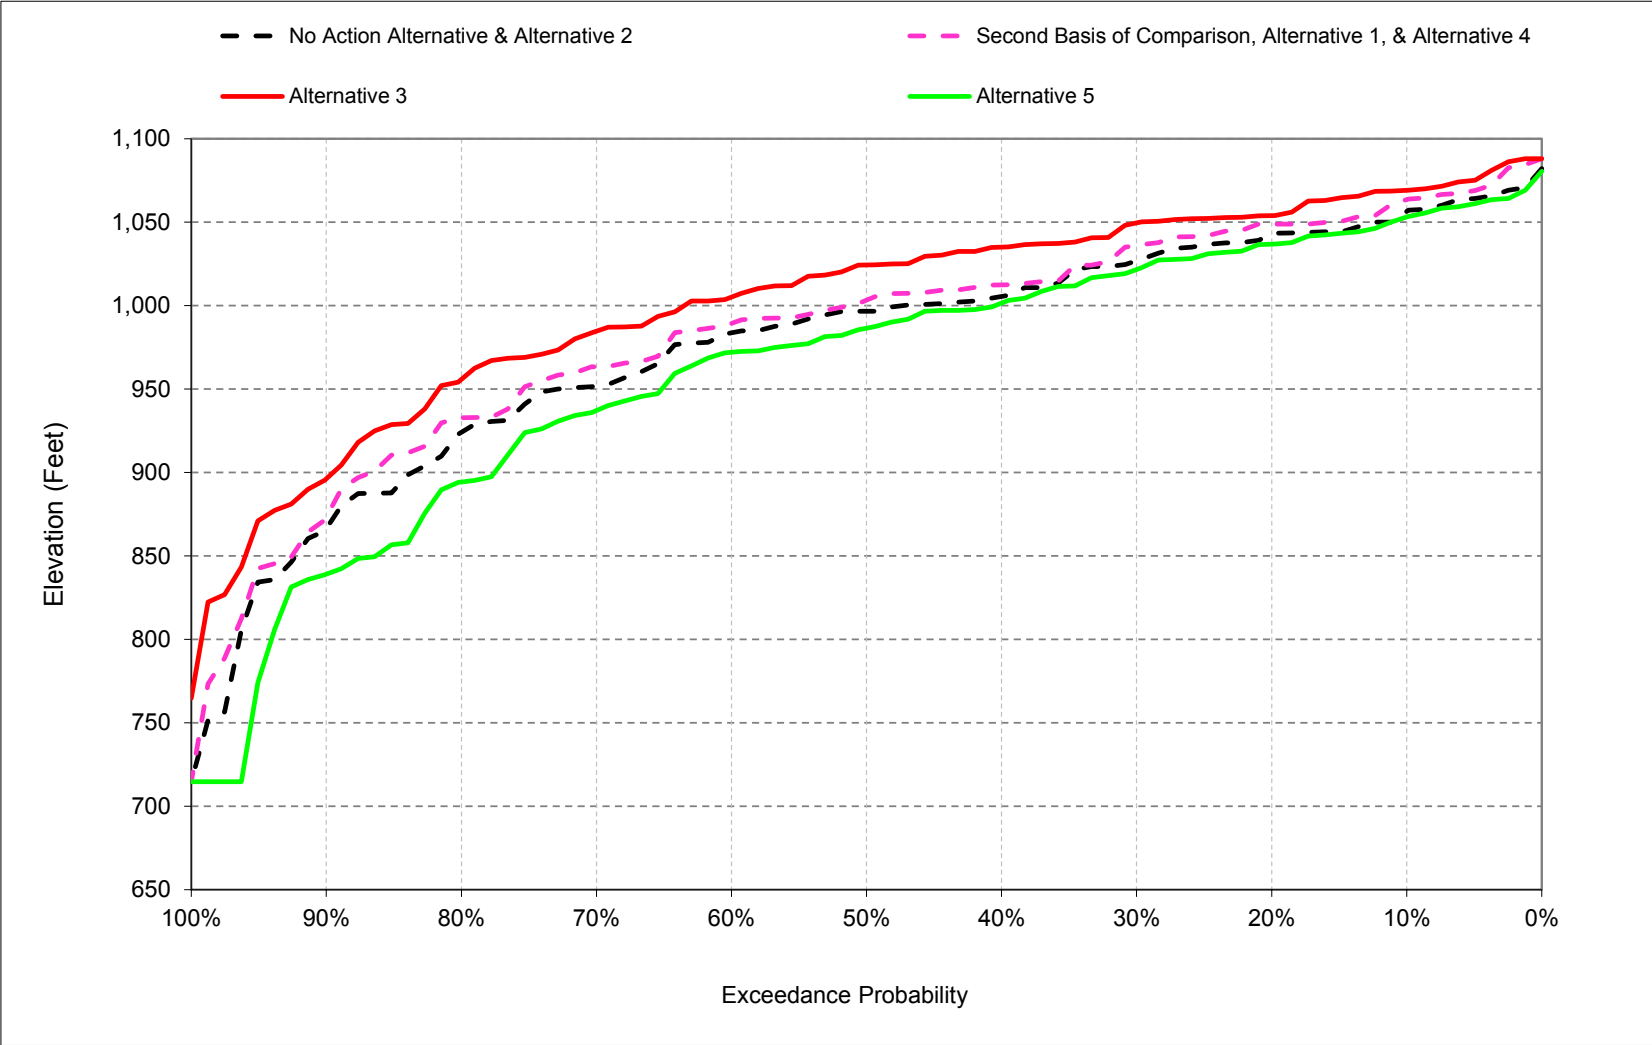

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-13-2. New Melones Reservoir, Reservoir Pool Elevation, September

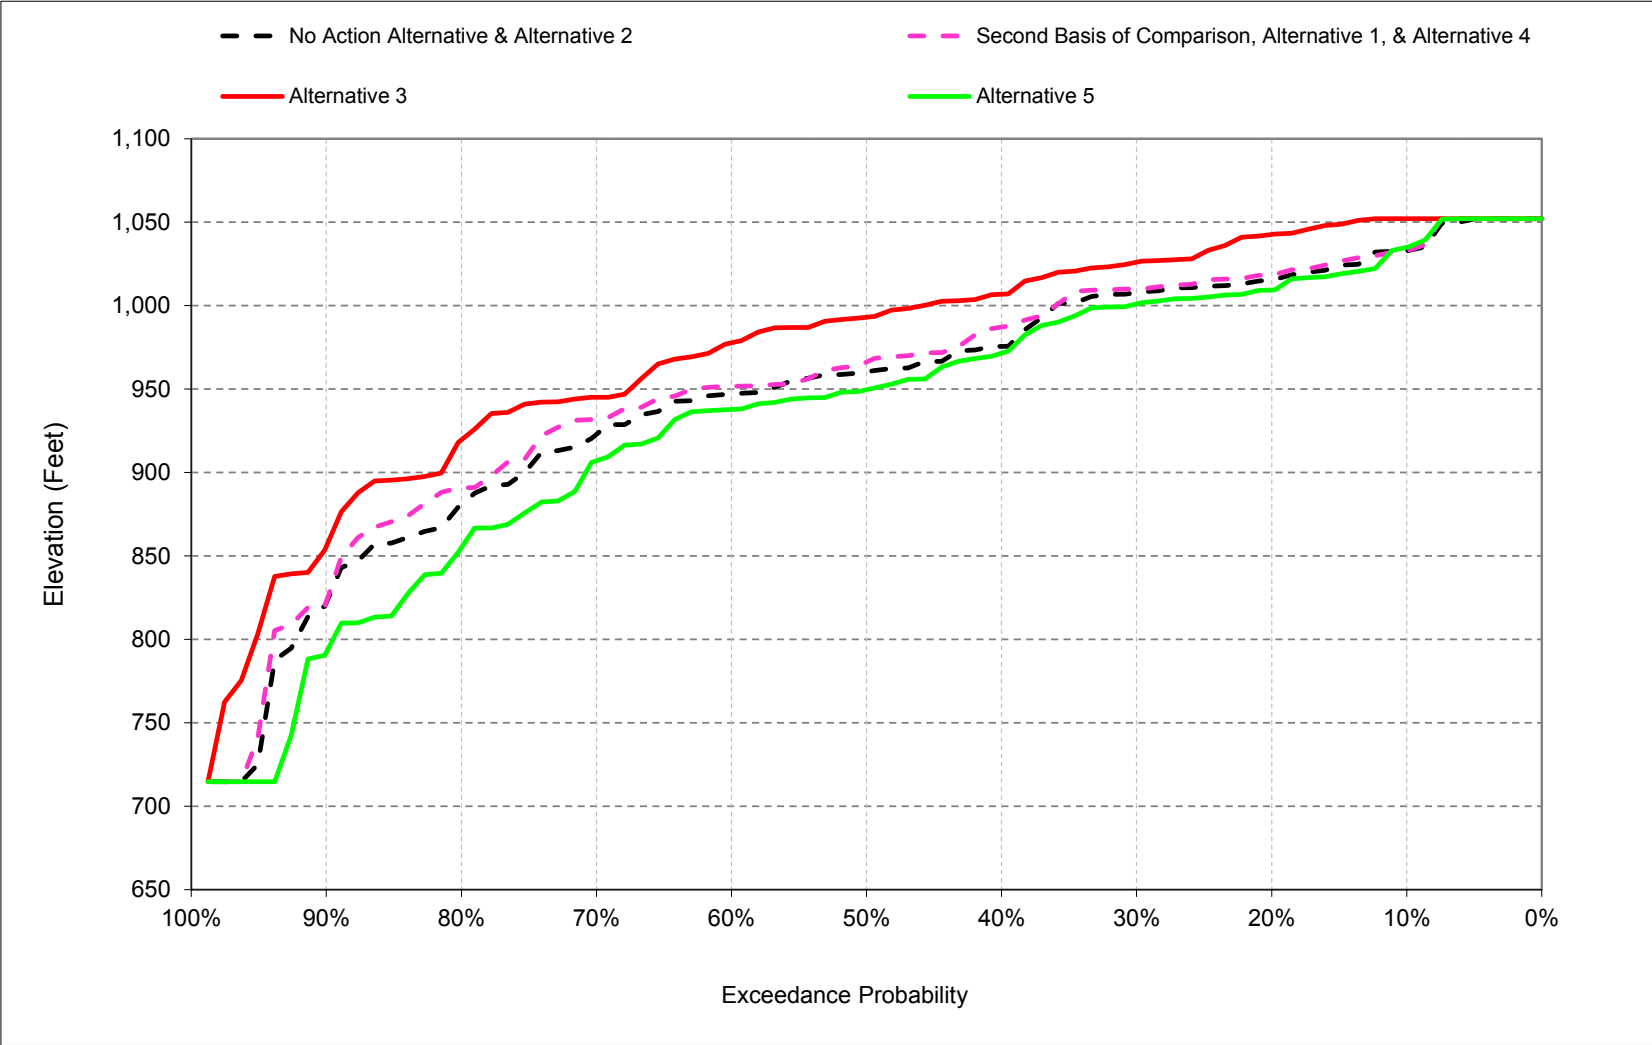

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-13-1. New Melones Reservoir, End of Month Elevation

No Action Alternative												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,029	1,028	1,035	1,040	1,046	1,050	1,047	1,057	1,059	1,050	1,039	1,033
20%	1,013	1,015	1,017	1,021	1,029	1,032	1,036	1,043	1,040	1,032	1,021	1,016
30%	1,006	1,006	1,008	1,012	1,021	1,025	1,021	1,027	1,031	1,023	1,013	1,008
40%	975	976	995	1,004	1,012	1,014	1,011	1,006	1,006	995	983	976
50%	956	957	960	980	996	1,006	998	997	991	977	965	961
60%	943	946	950	959	966	976	976	984	976	966	953	947
70%	925	928	938	942	945	947	950	952	951	939	928	929
80%	879	881	887	887	897	912	918	924	923	912	897	888
90%	835	836	837	847	857	863	864	867	876	863	850	843
Long Term												
Full Simulation Period ^b	944	945	951	958	968	974	973	976	976	965	954	948
Water Year Types^c												
Wet (32%)	980	982	990	1,004	1,016	1,023	1,026	1,039	1,047	1,040	1,029	1,022
Above Normal (16%)	932	937	945	960	974	986	988	997	996	985	973	897
Below Normal (13%)	968	969	972	975	985	988	985	985	983	972	960	955
Dry (24%)	943	943	944	947	951	957	955	953	948	934	922	915
Critical (15%)	856	856	862	864	870	871	860	848	840	828	818	812

Alternative 1												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,032	1,031	1,035	1,040	1,048	1,055	1,054	1,064	1,058	1,050	1,039	1,033
20%	1,018	1,018	1,019	1,021	1,037	1,045	1,041	1,049	1,041	1,035	1,024	1,019
30%	1,010	1,010	1,014	1,015	1,022	1,027	1,027	1,036	1,036	1,027	1,016	1,010
40%	988	988	999	1,008	1,014	1,020	1,017	1,012	1,014	1,003	994	988
50%	966	968	972	985	999	1,006	1,001	1,003	999	986	974	968
60%	952	952	956	967	974	984	989	989	981	969	957	952
70%	934	939	945	951	953	953	959	963	959	948	938	933
80%	892	892	896	901	915	931	929	933	927	918	902	891
90%	851	852	852	860	883	883	871	873	889	873	859	849
Long Term												
Full Simulation Period ^b	952	953	957	965	974	981	981	984	982	971	959	953
Water Year Types^c												
Wet (32%)	989	990	997	1,009	1,021	1,030	1,034	1,047	1,050	1,043	1,032	1,025
Above Normal (16%)	941	944	951	966	979	992	995	1,003	1,001	990	978	901
Below Normal (13%)	977	977	979	982	991	994	994	993	991	980	968	962
Dry (24%)	951	950	950	953	957	962	963	960	954	941	929	922
Critical (15%)	866	866	870	872	878	879	871	856	850	835	823	817

Alternative 1 minus No Action Alternative												
Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4	2	0	-1	2	4	6	7	0	0	0	0
20%	5	2	2	0	8	13	5	6	1	3	3	3
30%	4	5	6	3	1	1	7	9	5	4	3	2
40%	12	13	5	4	3	6	6	7	8	8	10	12
50%	10	11	12	5	4	1	2	7	8	10	9	7
60%	8	7	6	8	8	9	12	6	5	3	4	4
70%	10	10	7	9	8	6	9	12	8	9	9	4
80%	13	11	9	14	18	19	11	9	4	6	5	3
90%	16	17	15	14	26	19	7	7	14	11	8	6
Long Term												
Full Simulation Period ^b	9	8	7	6	6	6	9	8	6	5	5	5
Water Year Types^c												
Wet (32%)	9	8	7	6	5	8	8	8	3	3	3	3
Above Normal (16%)	9	7	6	6	6	6	8	7	5	5	5	5
Below Normal (13%)	9	8	7	7	6	6	9	8	7	8	8	8
Dry (24%)	8	7	6	6	5	5	8	7	7	7	7	7
Critical (15%)	10	10	9	8	8	8	11	8	10	6	5	6

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-13-2. New Melones Reservoir, End of Month Elevation

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance ^a												
10%	1,029	1,028	1,035	1,040	1,046	1,050	1,047	1,057	1,059	1,050	1,039	1,033
20%	1,013	1,015	1,017	1,021	1,029	1,032	1,036	1,043	1,040	1,032	1,021	1,016
30%	1,006	1,006	1,008	1,012	1,021	1,025	1,021	1,027	1,031	1,023	1,013	1,008
40%	975	976	995	1,004	1,012	1,014	1,011	1,006	1,006	995	983	976
50%	956	957	960	980	996	1,006	998	997	991	977	965	961
60%	943	946	950	959	966	976	976	984	976	966	953	947
70%	925	928	938	942	945	947	950	952	951	939	928	929
80%	879	881	887	887	897	912	918	924	923	912	897	888
90%	835	836	837	847	857	863	864	867	876	863	850	843
Long Term												
Full Simulation Period ^b	944	945	951	958	968	974	973	976	976	965	954	948
Water Year Types ^c												
Wet (32%)	980	982	990	1,004	1,016	1,023	1,026	1,039	1,047	1,040	1,029	1,022
Above Normal (16%)	932	937	945	960	974	986	988	997	996	985	973	897
Below Normal (13%)	968	969	972	975	985	988	985	985	983	972	960	955
Dry (24%)	943	943	944	947	951	957	955	953	948	934	922	915
Critical (15%)	856	856	862	864	870	871	860	848	840	828	818	812

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 3												
Probability of Exceedance ^a												
10%	1,049	1,048	1,050	1,050	1,050	1,055	1,057	1,069	1,076	1,070	1,061	1,052
20%	1,043	1,043	1,044	1,044	1,050	1,054	1,051	1,054	1,065	1,057	1,048	1,043
30%	1,025	1,025	1,031	1,038	1,045	1,050	1,044	1,050	1,051	1,040	1,031	1,027
40%	1,011	1,012	1,019	1,030	1,038	1,041	1,036	1,035	1,032	1,022	1,012	1,007
50%	995	994	996	1,008	1,018	1,024	1,020	1,024	1,020	1,008	998	994
60%	980	981	982	988	995	1,002	1,001	1,005	1,005	995	984	979
70%	946	950	964	967	978	975	974	985	976	963	952	945
80%	924	922	930	934	943	953	947	956	949	940	932	926
90%	877	879	879	886	906	911	897	896	918	901	886	876
Long Term												
Full Simulation Period ^b	974	974	978	985	993	999	998	1,002	1,003	992	981	975
Water Year Types ^c												
Wet (32%)	1,003	1,004	1,010	1,022	1,030	1,038	1,042	1,055	1,064	1,056	1,045	1,037
Above Normal (16%)	964	967	974	987	999	1,009	1,012	1,021	1,022	1,013	1,002	924
Below Normal (13%)	998	998	1,000	1,002	1,011	1,014	1,011	1,012	1,010	1,000	989	983
Dry (24%)	974	973	974	977	981	985	983	982	978	966	954	948
Critical (15%)	899	899	902	904	909	909	899	889	883	870	858	852

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 3 minus No Action Alternative												
Probability of Exceedance ^a												
10%	20	20	15	9	4	4	10	12	18	20	21	19
20%	29	28	27	23	20	22	15	11	25	25	27	27
30%	20	19	24	26	24	25	23	23	20	17	18	18
40%	35	36	24	26	26	27	25	30	26	27	29	31
50%	39	37	36	28	23	19	21	28	29	32	33	33
60%	37	36	31	29	29	26	25	21	29	29	30	32
70%	22	21	26	25	33	28	24	33	25	24	24	16
80%	45	41	43	48	45	41	30	32	26	28	35	38
90%	42	43	42	39	49	48	33	30	42	39	36	33
Long Term												
Full Simulation Period ^b	30	29	28	27	25	25	25	26	27	27	27	27
Water Year Types ^c												
Wet (32%)	23	22	20	18	14	16	15	16	17	16	16	16
Above Normal (16%)	32	30	29	28	25	23	24	24	27	28	29	27
Below Normal (13%)	30	29	28	27	26	26	26	27	27	28	28	28
Dry (24%)	32	31	30	30	30	29	29	29	31	31	32	33
Critical (15%)	43	43	40	40	38	38	39	41	43	41	40	40

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-13-3. New Melones Reservoir, End of Month Elevation

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance ^a												
10%	1,029	1,028	1,035	1,040	1,046	1,050	1,047	1,057	1,059	1,050	1,039	1,033
20%	1,013	1,015	1,017	1,021	1,029	1,032	1,036	1,043	1,040	1,032	1,021	1,016
30%	1,006	1,006	1,008	1,012	1,021	1,025	1,021	1,027	1,031	1,023	1,013	1,008
40%	975	976	995	1,004	1,012	1,014	1,011	1,006	1,006	995	983	976
50%	956	957	960	980	996	1,006	998	997	991	977	965	961
60%	943	946	950	959	966	976	976	984	976	966	953	947
70%	925	928	938	942	945	947	950	952	951	939	928	929
80%	879	881	887	887	897	912	918	924	923	912	897	888
90%	835	836	837	847	857	863	864	867	876	863	850	843
Long Term												
Full Simulation Period ^b	944	945	951	958	968	974	973	976	976	965	954	948
Water Year Types ^c												
Wet (32%)	980	982	990	1,004	1,016	1,023	1,026	1,039	1,047	1,040	1,029	1,022
Above Normal (16%)	932	937	945	960	974	986	988	997	996	985	973	897
Below Normal (13%)	968	969	972	975	985	988	985	985	983	972	960	955
Dry (24%)	943	943	944	947	951	957	955	953	948	934	922	915
Critical (15%)	856	856	862	864	870	871	860	848	840	828	818	812

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 5												
Probability of Exceedance ^a												
10%	1,029	1,028	1,036	1,041	1,047	1,049	1,043	1,053	1,062	1,053	1,043	1,035
20%	1,011	1,011	1,012	1,015	1,031	1,032	1,028	1,037	1,034	1,026	1,015	1,009
30%	999	998	1,001	1,007	1,015	1,019	1,020	1,022	1,024	1,016	1,005	1,002
40%	973	973	985	996	1,004	1,010	1,003	1,002	1,003	992	979	973
50%	945	948	959	970	996	998	991	987	978	965	953	951
60%	937	940	943	949	957	961	961	972	968	957	944	938
70%	904	911	921	928	932	936	941	937	939	927	915	909
80%	860	860	874	874	874	889	880	894	902	887	873	867
90%	803	807	808	824	834	838	826	839	847	833	818	810
Long Term												
Full Simulation Period ^b	931	933	939	947	957	964	961	962	963	952	941	935
Water Year Types ^c												
Wet (32%)	969	971	980	995	1,007	1,016	1,020	1,031	1,040	1,033	1,022	1,015
Above Normal (16%)	924	930	939	954	968	980	982	988	987	975	963	890
Below Normal (13%)	954	956	959	962	973	977	972	970	968	957	944	938
Dry (24%)	930	930	932	934	939	945	940	936	931	918	905	898
Critical (15%)	837	838	842	845	853	855	834	818	815	804	796	791

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 5 minus No Action Alternative												
Probability of Exceedance ^a												
10%	0	0	1	0	2	-1	-4	-3	4	3	3	2
20%	-2	-4	-5	-6	1	0	-8	-6	-6	-6	-6	-6
30%	-7	-8	-7	-5	-6	-6	-1	-5	-6	-7	-7	-6
40%	-3	-3	-9	-8	-7	-5	-8	-4	-3	-3	-5	-3
50%	-11	-9	-1	-10	0	-8	-7	-10	-13	-12	-12	-10
60%	-6	-6	-7	-10	-8	-15	-16	-12	-8	-9	-9	-9
70%	-21	-18	-17	-14	-13	-11	-10	-15	-13	-12	-14	-19
80%	-19	-21	-13	-13	-23	-22	-38	-30	-21	-25	-24	-21
90%	-32	-28	-29	-23	-23	-25	-38	-27	-28	-29	-32	-33
Long Term												
Full Simulation Period ^b	-12	-12	-12	-11	-11	-10	-12	-14	-13	-13	-13	-13
Water Year Types ^c												
Wet (32%)	-11	-11	-10	-9	-8	-7	-7	-7	-7	-7	-6	-6
Above Normal (16%)	-8	-7	-6	-6	-6	-6	-6	-8	-8	-9	-10	-7
Below Normal (13%)	-13	-13	-13	-13	-12	-12	-13	-15	-15	-15	-16	-16
Dry (24%)	-13	-13	-12	-13	-12	-12	-15	-17	-17	-17	-17	-17
Critical (15%)	-19	-18	-20	-19	-17	-16	-26	-30	-25	-24	-22	-21

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-13-4. New Melones Reservoir, End of Month Elevation

Second Basis of Comparison		End of Month Elevation (Feet)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	1,032	1,031	1,035	1,040	1,048	1,055	1,054	1,064	1,058	1,050	1,039	1,033	
20%	1,018	1,018	1,019	1,021	1,037	1,045	1,041	1,049	1,041	1,035	1,024	1,019	
30%	1,010	1,010	1,014	1,015	1,022	1,027	1,027	1,036	1,036	1,027	1,016	1,010	
40%	988	988	999	1,008	1,014	1,020	1,017	1,012	1,014	1,003	994	988	
50%	966	968	972	985	999	1,006	1,001	1,003	999	986	974	968	
60%	952	952	956	967	974	984	989	989	981	969	957	952	
70%	934	939	945	951	953	953	959	963	959	948	938	933	
80%	892	892	896	901	915	931	929	933	927	918	902	891	
90%	851	852	852	860	883	883	871	873	889	873	859	849	
Long Term													
Full Simulation Period ^b	952	953	957	965	974	981	981	984	982	971	959	953	
Water Year Types^c													
Wet (32%)	989	990	997	1,009	1,021	1,030	1,034	1,047	1,050	1,043	1,032	1,025	
Above Normal (16%)	941	944	951	966	979	992	995	1,003	1,001	990	978	901	
Below Normal (13%)	977	977	979	982	991	994	994	993	991	980	968	962	
Dry (24%)	951	950	950	953	957	962	963	960	954	941	929	922	
Critical (15%)	866	866	870	872	878	879	871	856	850	835	823	817	

No Action Alternative		End of Month Elevation (Feet)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	1,029	1,028	1,035	1,040	1,046	1,050	1,047	1,057	1,059	1,050	1,039	1,033	
20%	1,013	1,015	1,017	1,021	1,029	1,032	1,036	1,043	1,040	1,032	1,021	1,016	
30%	1,006	1,006	1,008	1,012	1,021	1,025	1,021	1,027	1,031	1,023	1,013	1,008	
40%	975	976	995	1,004	1,012	1,014	1,011	1,006	1,006	995	983	976	
50%	956	957	960	980	996	1,006	998	997	991	977	965	961	
60%	943	946	950	959	966	976	976	984	976	966	953	947	
70%	925	928	938	942	945	947	950	952	951	939	928	929	
80%	879	881	887	887	897	912	918	924	923	912	897	888	
90%	835	836	837	847	857	863	864	867	876	863	850	843	
Long Term													
Full Simulation Period ^b	944	945	951	958	968	974	973	976	976	965	954	948	
Water Year Types^c													
Wet (32%)	980	982	990	1,004	1,016	1,023	1,026	1,039	1,047	1,040	1,029	1,022	
Above Normal (16%)	932	937	945	960	974	986	988	997	996	985	973	897	
Below Normal (13%)	968	969	972	975	985	988	985	985	983	972	960	955	
Dry (24%)	943	943	944	947	951	957	955	953	948	934	922	915	
Critical (15%)	856	856	862	864	870	871	860	848	840	828	818	812	

No Action Alternative minus Second Basis of Comparison		End of Month Elevation (Feet)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	-4	-2	0	1	-2	-4	-6	-7	0	0	0	0	
20%	-5	-2	-2	0	-8	-13	-5	-6	-1	-3	-3	-3	
30%	-4	-5	-6	-3	-1	-1	-7	-9	-5	-4	-3	-2	
40%	-12	-13	-5	-4	-3	-6	-6	-7	-8	-8	-10	-12	
50%	-10	-11	-12	-5	-4	-1	-2	-7	-8	-10	-9	-7	
60%	-8	-7	-6	-8	-8	-9	-12	-6	-5	-3	-4	-4	
70%	-10	-10	-7	-9	-8	-6	-9	-12	-8	-9	-9	-4	
80%	-13	-11	-9	-14	-18	-19	-11	-9	-4	-6	-5	-3	
90%	-16	-17	-15	-14	-26	-19	-7	-7	-14	-11	-8	-6	
Long Term													
Full Simulation Period ^b	-9	-8	-7	-6	-6	-6	-9	-8	-6	-5	-5	-5	
Water Year Types^c													
Wet (32%)	-9	-8	-7	-6	-5	-8	-8	-8	-3	-3	-3	-3	
Above Normal (16%)	-9	-7	-6	-6	-6	-6	-8	-7	-5	-5	-5	-5	
Below Normal (13%)	-9	-8	-7	-7	-6	-6	-9	-8	-7	-8	-8	-8	
Dry (24%)	-8	-7	-6	-6	-5	-5	-8	-7	-7	-7	-7	-7	
Critical (15%)	-10	-10	-9	-8	-8	-8	-11	-8	-10	-6	-5	-6	

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-13-5. New Melones Reservoir, End of Month Elevation

Second Basis of Comparison		End of Month Elevation (Feet)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	1,032	1,031	1,035	1,040	1,048	1,055	1,054	1,064	1,058	1,050	1,039	1,033	
20%	1,018	1,018	1,019	1,021	1,037	1,045	1,041	1,049	1,041	1,035	1,024	1,019	
30%	1,010	1,010	1,014	1,015	1,022	1,027	1,027	1,036	1,036	1,027	1,016	1,010	
40%	988	988	999	1,008	1,014	1,020	1,017	1,012	1,014	1,003	994	988	
50%	966	968	972	985	999	1,006	1,001	1,003	999	986	974	968	
60%	952	952	956	967	974	984	989	989	981	969	957	952	
70%	934	939	945	951	953	953	959	963	959	948	938	933	
80%	892	892	896	901	915	931	929	933	927	918	902	891	
90%	851	852	852	860	883	883	871	873	889	873	859	849	
Long Term													
Full Simulation Period ^b	952	953	957	965	974	981	981	984	982	971	959	953	
Water Year Types^c													
Wet (32%)	989	990	997	1,009	1,021	1,030	1,034	1,047	1,050	1,043	1,032	1,025	
Above Normal (16%)	941	944	951	966	979	992	995	1,003	1,001	990	978	901	
Below Normal (13%)	977	977	979	982	991	994	994	993	991	980	968	962	
Dry (24%)	951	950	950	953	957	962	963	960	954	941	929	922	
Critical (15%)	866	866	870	872	878	879	871	856	850	835	823	817	

Alternative 3		End of Month Elevation (Feet)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	1,049	1,048	1,050	1,050	1,050	1,055	1,057	1,069	1,076	1,070	1,061	1,052	
20%	1,043	1,043	1,044	1,044	1,050	1,054	1,051	1,054	1,065	1,057	1,048	1,043	
30%	1,025	1,025	1,031	1,038	1,045	1,050	1,044	1,050	1,051	1,040	1,031	1,027	
40%	1,011	1,012	1,019	1,030	1,038	1,041	1,036	1,035	1,032	1,022	1,012	1,007	
50%	995	994	996	1,008	1,018	1,024	1,020	1,024	1,020	1,008	998	994	
60%	980	981	982	988	995	1,002	1,001	1,005	1,005	995	984	979	
70%	946	950	964	967	978	975	974	985	976	963	952	945	
80%	924	922	930	934	943	953	947	956	949	940	932	926	
90%	877	879	879	886	906	911	897	896	918	901	886	876	
Long Term													
Full Simulation Period ^b	974	974	978	985	993	999	998	1,002	1,003	992	981	975	
Water Year Types^c													
Wet (32%)	1,003	1,004	1,010	1,022	1,030	1,038	1,042	1,055	1,064	1,056	1,045	1,037	
Above Normal (16%)	964	967	974	987	999	1,009	1,012	1,021	1,022	1,013	1,002	924	
Below Normal (13%)	998	998	1,000	1,002	1,011	1,014	1,011	1,012	1,010	1,000	989	983	
Dry (24%)	974	973	974	977	981	985	983	982	978	966	954	948	
Critical (15%)	899	899	902	904	909	909	899	889	883	870	858	852	

Alternative 3 minus Second Basis of Comparison		End of Month Elevation (Feet)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	17	17	14	10	2	0	4	6	18	20	22	19	
20%	25	25	25	22	12	9	10	5	24	21	24	24	
30%	16	15	18	23	23	23	16	14	15	14	15	17	
40%	23	24	20	22	23	21	19	23	18	19	19	19	
50%	29	26	24	22	19	18	19	21	21	22	25	25	
60%	29	29	25	21	21	17	12	16	23	26	26	27	
70%	12	11	19	16	25	22	15	21	17	15	14	12	
80%	31	30	33	34	28	22	19	23	22	22	30	35	
90%	26	27	27	26	23	29	26	23	28	28	28	27	
Long Term													
Full Simulation Period ^b	21	21	21	21	19	18	16	18	21	22	22	22	
Water Year Types^c													
Wet (32%)	14	14	13	12	9	8	7	8	14	13	13	12	
Above Normal (16%)	23	23	23	21	19	18	16	18	21	23	24	23	
Below Normal (13%)	20	21	21	21	20	20	17	19	20	20	21	21	
Dry (24%)	24	24	24	24	25	23	20	23	24	24	25	26	
Critical (15%)	33	33	31	32	31	30	28	33	33	35	35	34	

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-13-6. New Melones Reservoir, End of Month Elevation

Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,032	1,031	1,035	1,040	1,048	1,055	1,054	1,064	1,058	1,050	1,039	1,033
20%	1,018	1,018	1,019	1,021	1,037	1,045	1,041	1,049	1,041	1,035	1,024	1,019
30%	1,010	1,010	1,014	1,015	1,022	1,027	1,027	1,036	1,036	1,027	1,016	1,010
40%	988	988	999	1,008	1,014	1,020	1,017	1,012	1,014	1,003	994	988
50%	966	968	972	985	999	1,006	1,001	1,003	999	986	974	968
60%	952	952	956	967	974	984	989	989	981	969	957	952
70%	934	939	945	951	953	953	959	963	959	948	938	933
80%	892	892	896	901	915	931	929	933	927	918	902	891
90%	851	852	852	860	883	883	871	873	889	873	859	849
Long Term												
Full Simulation Period ^b	952	953	957	965	974	981	981	984	982	971	959	953
Water Year Types^c												
Wet (32%)	989	990	997	1,009	1,021	1,030	1,034	1,047	1,050	1,043	1,032	1,025
Above Normal (16%)	941	944	951	966	979	992	995	1,003	1,001	990	978	901
Below Normal (13%)	977	977	979	982	991	994	994	993	991	980	968	962
Dry (24%)	951	950	950	953	957	962	963	960	954	941	929	922
Critical (15%)	866	866	870	872	878	879	871	856	850	835	823	817

Alternative 5

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,029	1,028	1,036	1,041	1,047	1,049	1,043	1,053	1,062	1,053	1,043	1,035
20%	1,011	1,011	1,012	1,015	1,031	1,032	1,028	1,037	1,034	1,026	1,015	1,009
30%	999	998	1,001	1,007	1,015	1,019	1,020	1,022	1,024	1,016	1,005	1,002
40%	973	973	985	996	1,004	1,010	1,003	1,002	1,003	992	979	973
50%	945	948	959	970	996	998	991	987	978	965	953	951
60%	937	940	943	949	957	961	961	972	968	957	944	938
70%	904	911	921	928	932	936	941	937	939	927	915	909
80%	860	860	874	874	874	889	880	894	902	887	873	867
90%	803	807	808	824	834	838	826	839	847	833	818	810
Long Term												
Full Simulation Period ^b	931	933	939	947	957	964	961	962	963	952	941	935
Water Year Types^c												
Wet (32%)	969	971	980	995	1,007	1,016	1,020	1,031	1,040	1,033	1,022	1,015
Above Normal (16%)	924	930	939	954	968	980	982	988	987	975	963	890
Below Normal (13%)	954	956	959	962	973	977	972	970	968	957	944	938
Dry (24%)	930	930	932	934	939	945	940	936	931	918	905	898
Critical (15%)	837	838	842	845	853	855	834	818	815	804	796	791

Alternative 5 minus Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-4	-2	0	1	0	-5	-10	-10	4	3	3	2
20%	-7	-7	-7	-7	-7	-14	-13	-12	-7	-9	-9	-9
30%	-11	-12	-12	-8	-7	-7	-7	-14	-12	-11	-11	-8
40%	-15	-15	-14	-12	-10	-10	-14	-11	-11	-11	-15	-15
50%	-21	-20	-14	-16	-4	-9	-9	-17	-21	-22	-21	-18
60%	-15	-13	-13	-18	-16	-23	-28	-17	-13	-12	-13	-14
70%	-31	-28	-24	-23	-21	-16	-18	-26	-20	-21	-23	-24
80%	-32	-33	-22	-27	-41	-42	-49	-39	-25	-31	-29	-24
90%	-47	-45	-44	-36	-49	-44	-45	-34	-42	-40	-41	-40
Long Term												
Full Simulation Period ^b	-21	-20	-19	-18	-17	-17	-21	-22	-19	-19	-18	-18
Water Year Types^c												
Wet (32%)	-20	-19	-17	-15	-14	-15	-15	-16	-10	-10	-10	-9
Above Normal (16%)	-17	-14	-12	-12	-12	-11	-14	-15	-14	-15	-15	-11
Below Normal (13%)	-23	-22	-20	-20	-18	-18	-22	-23	-22	-23	-24	-24
Dry (24%)	-21	-20	-19	-19	-18	-17	-23	-24	-23	-24	-24	-25
Critical (15%)	-29	-28	-29	-27	-25	-24	-37	-38	-35	-31	-27	-27

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 **C.14. Millerton Lake Elevation**

Figure C-14-1. Millerton Lake, Reservoir Pool Elevation, May

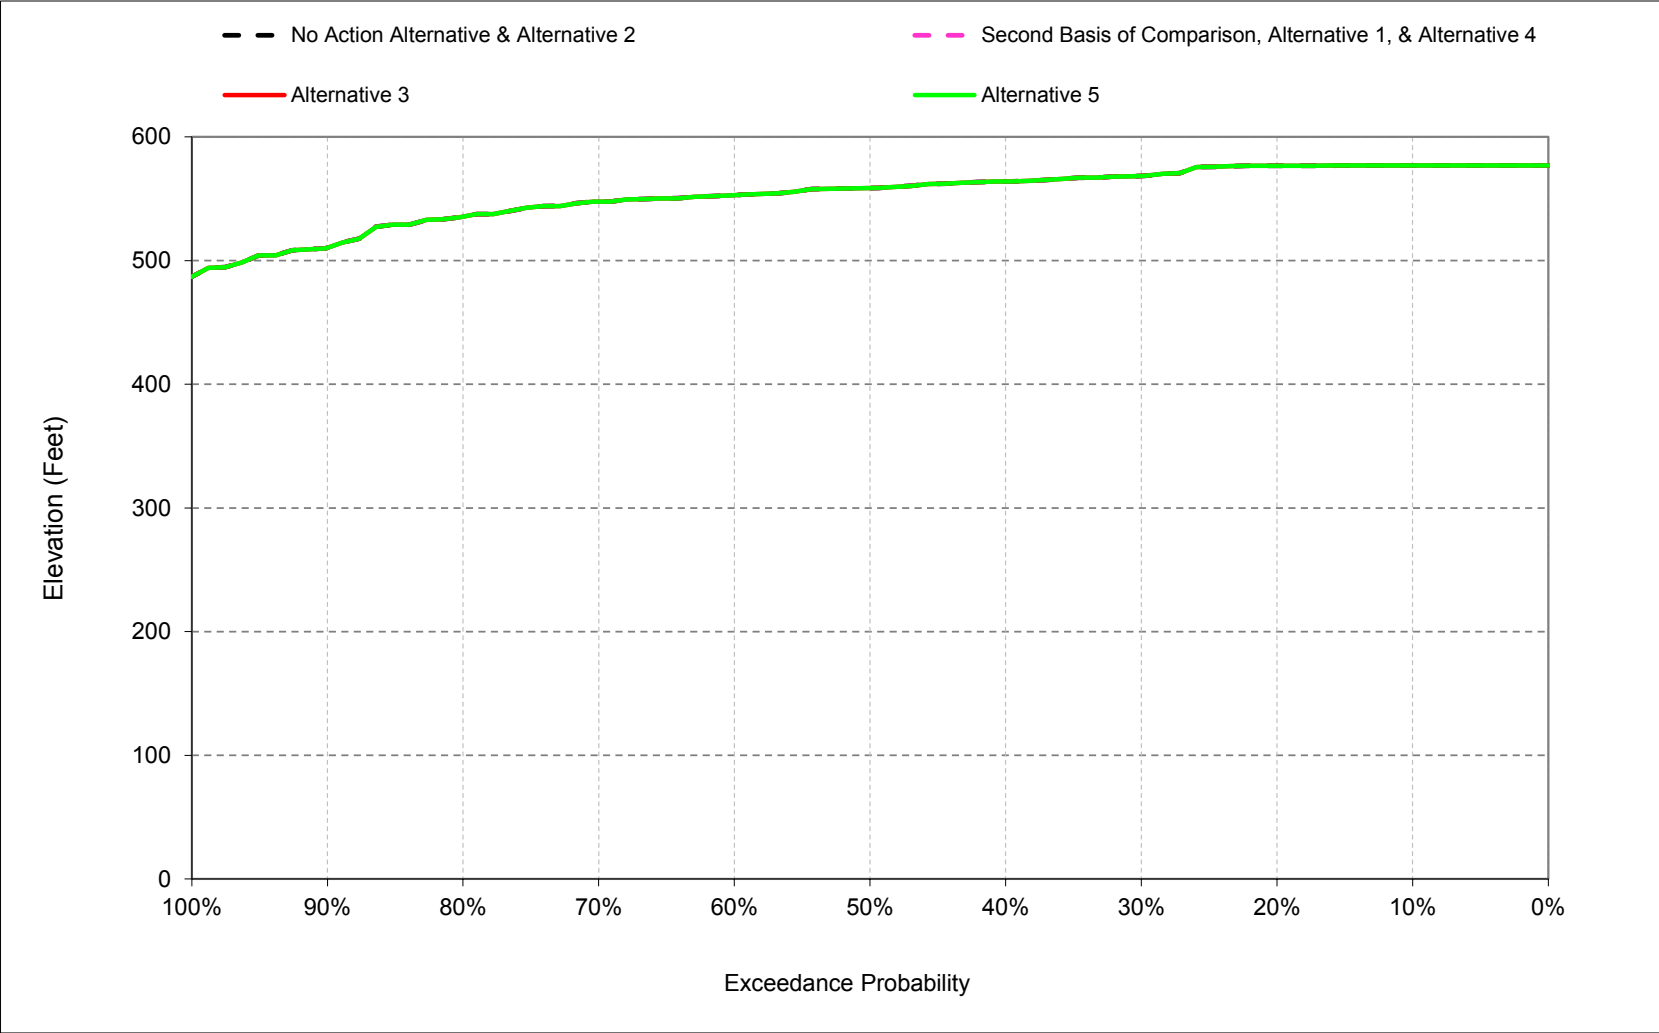

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-14-2. Millerton Lake, Reservoir Pool Elevation, September

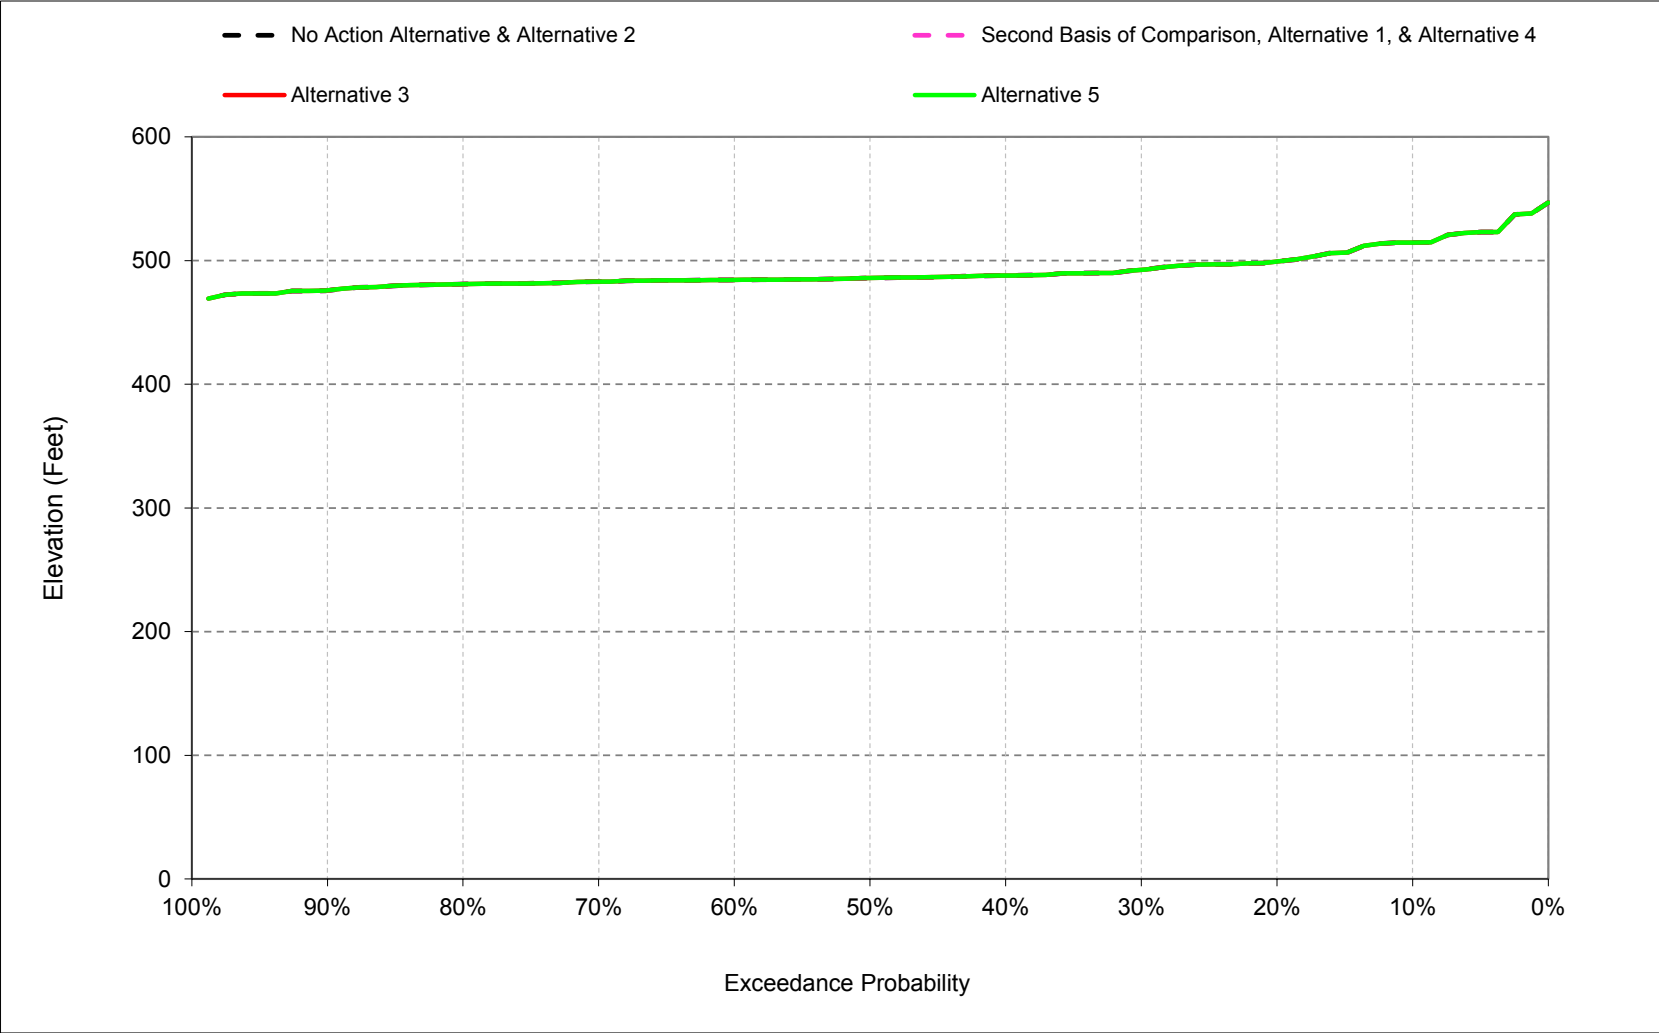

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-14-1. Millerton Lake, End of Month Elevation

No Action Alternative												
Statistic	End of Month Elevation (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	515	524	546	561	561	568	570	577	577	571	530	515
20%	503	517	532	555	561	568	562	577	576	559	515	499
30%	498	512	525	540	561	567	557	568	573	543	498	493
40%	493	502	518	536	556	560	551	564	568	533	490	488
50%	491	498	513	528	549	551	546	559	556	522	486	486
60%	486	492	506	523	537	545	538	553	551	514	482	484
70%	483	485	499	514	531	534	529	548	544	504	479	483
80%	479	481	493	506	517	519	517	536	531	493	477	481
90%	475	475	483	490	496	496	503	510	510	479	467	477
Long Term												
Full Simulation Period ^b	493	500	513	527	538	542	539	553	552	524	494	491
Water Year Types^c												
Wet (23%)	494	502	527	547	558	562	538	556	574	565	528	512
Above Normal (24%)	494	502	516	536	555	562	551	570	572	541	497	487
Below Normal (10%)	490	502	511	524	540	542	539	552	550	521	488	487
Dry (16%)	498	507	516	526	533	535	546	556	545	505	479	487
Critical (27%)	488	490	497	503	508	511	526	533	518	486	472	482

Alternative 1												
Statistic	End of Month Elevation (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	515	524	546	561	561	568	570	577	577	571	530	515
20%	503	517	532	555	561	568	562	577	576	559	515	499
30%	498	512	525	540	561	567	557	568	573	543	498	493
40%	493	502	518	536	556	560	551	564	568	533	490	488
50%	491	498	513	528	549	551	546	559	556	522	486	486
60%	486	492	506	523	537	545	538	553	551	514	482	484
70%	483	485	499	514	531	534	529	548	544	504	479	483
80%	479	481	493	506	517	519	517	536	531	493	477	481
90%	475	475	483	490	496	496	503	510	510	479	467	477
Long Term												
Full Simulation Period ^b	493	500	513	527	538	542	539	553	552	524	494	491
Water Year Types^c												
Wet (23%)	494	502	527	547	558	562	538	556	574	565	528	512
Above Normal (24%)	494	502	516	536	555	562	551	570	572	541	497	487
Below Normal (10%)	490	502	511	524	540	542	539	552	550	521	488	487
Dry (16%)	498	507	516	526	533	535	546	556	545	505	479	487
Critical (27%)	488	490	497	503	508	511	526	533	518	486	472	482

Alternative 1 minus No Action Alternative												
Statistic	End of Month Elevation (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types^c												
Wet (23%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (10%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (27%)	0	0	0	0	0	0	0	0	0	0	0	0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-14-2. Millerton Lake, End of Month Elevation

No Action Alternative												
Statistic	End of Month Elevation (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	515	524	546	561	561	568	570	577	577	571	530	515
20%	503	517	532	555	561	568	562	577	576	559	515	499
30%	498	512	525	540	561	567	557	568	573	543	498	493
40%	493	502	518	536	556	560	551	564	568	533	490	488
50%	491	498	513	528	549	551	546	559	556	522	486	486
60%	486	492	506	523	537	545	538	553	551	514	482	484
70%	483	485	499	514	531	534	529	548	544	504	479	483
80%	479	481	493	506	517	519	517	536	531	493	477	481
90%	475	475	483	490	496	496	503	510	510	479	467	477
Long Term												
Full Simulation Period ^b	493	500	513	527	538	542	539	553	552	524	494	491
Water Year Types^c												
Wet (23%)	494	502	527	547	558	562	538	556	574	565	528	512
Above Normal (24%)	494	502	516	536	555	562	551	570	572	541	497	487
Below Normal (10%)	490	502	511	524	540	542	539	552	550	521	488	487
Dry (16%)	498	507	516	526	533	535	546	556	545	505	479	487
Critical (27%)	488	490	497	503	508	511	526	533	518	486	472	482

Alternative 3												
Statistic	End of Month Elevation (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	515	524	546	561	561	568	570	577	577	571	530	515
20%	503	517	532	555	561	568	562	577	576	559	515	499
30%	498	512	525	540	561	567	557	568	573	543	498	493
40%	493	502	518	536	556	560	551	564	568	533	490	488
50%	491	498	513	528	549	551	546	559	556	522	486	486
60%	486	492	506	523	537	545	538	553	551	514	482	484
70%	483	485	499	514	531	534	529	548	544	504	479	483
80%	479	481	493	506	517	519	517	536	531	493	477	481
90%	475	475	483	490	496	496	503	510	510	479	467	477
Long Term												
Full Simulation Period ^b	493	500	513	527	538	542	539	553	552	524	494	491
Water Year Types^c												
Wet (23%)	494	502	527	547	558	562	538	556	574	565	528	512
Above Normal (24%)	494	502	516	536	555	562	551	570	572	541	497	487
Below Normal (10%)	490	502	511	524	540	542	539	552	550	521	488	487
Dry (16%)	498	507	516	526	533	535	546	556	545	505	479	487
Critical (27%)	488	490	497	503	508	511	526	533	518	486	472	482

Alternative 3 minus No Action Alternative												
Statistic	End of Month Elevation (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types^c												
Wet (23%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (10%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (27%)	0	0	0	0	0	0	0	0	0	0	0	0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-14-3. Millerton Lake, End of Month Elevation

No Action Alternative												
Statistic	End of Month Elevation (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	515	524	546	561	561	568	570	577	577	571	530	515
20%	503	517	532	555	561	568	562	577	576	559	515	499
30%	498	512	525	540	561	567	557	568	573	543	498	493
40%	493	502	518	536	556	560	551	564	568	533	490	488
50%	491	498	513	528	549	551	546	559	556	522	486	486
60%	486	492	506	523	537	545	538	553	551	514	482	484
70%	483	485	499	514	531	534	529	548	544	504	479	483
80%	479	481	493	506	517	519	517	536	531	493	477	481
90%	475	475	483	490	496	496	503	510	510	479	467	477
Long Term												
Full Simulation Period ^b	493	500	513	527	538	542	539	553	552	524	494	491
Water Year Types^c												
Wet (23%)	494	502	527	547	558	562	538	556	574	565	528	512
Above Normal (24%)	494	502	516	536	555	562	551	570	572	541	497	487
Below Normal (10%)	490	502	511	524	540	542	539	552	550	521	488	487
Dry (16%)	498	507	516	526	533	535	546	556	545	505	479	487
Critical (27%)	488	490	497	503	508	511	526	533	518	486	472	482

Alternative 5												
Statistic	End of Month Elevation (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	515	524	546	561	561	568	570	577	577	571	530	515
20%	503	517	532	555	561	568	562	577	576	559	515	499
30%	498	512	525	540	561	567	557	568	573	543	498	493
40%	493	502	518	536	556	560	551	564	568	533	490	488
50%	491	498	513	528	549	551	546	559	556	522	486	486
60%	486	492	506	523	537	545	538	553	551	514	482	484
70%	483	485	499	514	531	534	529	548	544	504	479	483
80%	479	481	493	506	517	519	517	536	531	493	477	481
90%	475	475	483	490	496	496	503	510	510	479	467	477
Long Term												
Full Simulation Period ^b	493	500	513	527	538	542	539	553	552	524	494	491
Water Year Types^c												
Wet (23%)	494	502	527	547	558	562	538	556	574	565	528	512
Above Normal (24%)	494	502	516	536	555	562	551	570	572	541	497	487
Below Normal (10%)	490	502	511	524	540	542	539	552	550	521	488	487
Dry (16%)	498	507	516	526	533	535	546	556	545	505	479	487
Critical (27%)	488	490	497	503	508	511	526	533	518	486	472	482

Alternative 5 minus No Action Alternative												
Statistic	End of Month Elevation (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types^c												
Wet (23%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (10%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (27%)	0	0	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-14-4. Millerton Lake, End of Month Elevation

Statistic	End of Month Elevation (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance^a												
10%	515	524	546	561	561	568	570	577	577	571	530	515
20%	503	517	532	555	561	568	562	577	576	559	515	499
30%	498	512	525	540	561	567	557	568	573	543	498	493
40%	493	502	518	536	556	560	551	564	568	533	490	488
50%	491	498	513	528	549	551	546	559	556	522	486	486
60%	486	492	506	523	537	545	538	553	551	514	482	484
70%	483	485	499	514	531	534	529	548	544	504	479	483
80%	479	481	493	506	517	519	517	536	531	493	477	481
90%	475	475	483	490	496	496	503	510	510	479	467	477
Long Term												
Full Simulation Period ^b	493	500	513	527	538	542	539	553	552	524	494	491
Water Year Types^c												
Wet (23%)	494	502	527	547	558	562	538	556	574	565	528	512
Above Normal (24%)	494	502	516	536	555	562	551	570	572	541	497	487
Below Normal (10%)	490	502	511	524	540	542	539	552	550	521	488	487
Dry (16%)	498	507	516	526	533	535	546	556	545	505	479	487
Critical (27%)	488	490	497	503	508	511	526	533	518	486	472	482

Statistic	End of Month Elevation (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance^a												
10%	515	524	546	561	561	568	570	577	577	571	530	515
20%	503	517	532	555	561	568	562	577	576	559	515	499
30%	498	512	525	540	561	567	557	568	573	543	498	493
40%	493	502	518	536	556	560	551	564	568	533	490	488
50%	491	498	513	528	549	551	546	559	556	522	486	486
60%	486	492	506	523	537	545	538	553	551	514	482	484
70%	483	485	499	514	531	534	529	548	544	504	479	483
80%	479	481	493	506	517	519	517	536	531	493	477	481
90%	475	475	483	490	496	496	503	510	510	479	467	477
Long Term												
Full Simulation Period ^b	493	500	513	527	538	542	539	553	552	524	494	491
Water Year Types^c												
Wet (23%)	494	502	527	547	558	562	538	556	574	565	528	512
Above Normal (24%)	494	502	516	536	555	562	551	570	572	541	497	487
Below Normal (10%)	490	502	511	524	540	542	539	552	550	521	488	487
Dry (16%)	498	507	516	526	533	535	546	556	545	505	479	487
Critical (27%)	488	490	497	503	508	511	526	533	518	486	472	482

Statistic	End of Month Elevation (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative minus Second Basis of Comparison												
Probability of Exceedance^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types^c												
Wet (23%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (10%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (27%)	0	0	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-14-5. Millerton Lake, End of Month Elevation

Second Basis of Comparison												
Statistic	End of Month Elevation (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	515	524	546	561	561	568	570	577	577	571	530	515
20%	503	517	532	555	561	568	562	577	576	559	515	499
30%	498	512	525	540	561	567	557	568	573	543	498	493
40%	493	502	518	536	556	560	551	564	568	533	490	488
50%	491	498	513	528	549	551	546	559	556	522	486	486
60%	486	492	506	523	537	545	538	553	551	514	482	484
70%	483	485	499	514	531	534	529	548	544	504	479	483
80%	479	481	493	506	517	519	517	536	531	493	477	481
90%	475	475	483	490	496	496	503	510	510	479	467	477
Long Term												
Full Simulation Period ^b	493	500	513	527	538	542	539	553	552	524	494	491
Water Year Types^c												
Wet (23%)	494	502	527	547	558	562	538	556	574	565	528	512
Above Normal (24%)	494	502	516	536	555	562	551	570	572	541	497	487
Below Normal (10%)	490	502	511	524	540	542	539	552	550	521	488	487
Dry (16%)	498	507	516	526	533	535	546	556	545	505	479	487
Critical (27%)	488	490	497	503	508	511	526	533	518	486	472	482

Alternative 3												
Statistic	End of Month Elevation (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	515	524	546	561	561	568	570	577	577	571	530	515
20%	503	517	532	555	561	568	562	577	576	559	515	499
30%	498	512	525	540	561	567	557	568	573	543	498	493
40%	493	502	518	536	556	560	551	564	568	533	490	488
50%	491	498	513	528	549	551	546	559	556	522	486	486
60%	486	492	506	523	537	545	538	553	551	514	482	484
70%	483	485	499	514	531	534	529	548	544	504	479	483
80%	479	481	493	506	517	519	517	536	531	493	477	481
90%	475	475	483	490	496	496	503	510	510	479	467	477
Long Term												
Full Simulation Period ^b	493	500	513	527	538	542	539	553	552	524	494	491
Water Year Types^c												
Wet (23%)	494	502	527	547	558	562	538	556	574	565	528	512
Above Normal (24%)	494	502	516	536	555	562	551	570	572	541	497	487
Below Normal (10%)	490	502	511	524	540	542	539	552	550	521	488	487
Dry (16%)	498	507	516	526	533	535	546	556	545	505	479	487
Critical (27%)	488	490	497	503	508	511	526	533	518	486	472	482

Alternative 3 minus Second Basis of Comparison												
Statistic	End of Month Elevation (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types^c												
Wet (23%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (10%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (27%)	0	0	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-14-6. Millerton Lake, End of Month Elevation

Second Basis of Comparison												
Statistic	End of Month Elevation (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	515	524	546	561	561	568	570	577	577	571	530	515
20%	503	517	532	555	561	568	562	577	576	559	515	499
30%	498	512	525	540	561	567	557	568	573	543	498	493
40%	493	502	518	536	556	560	551	564	568	533	490	488
50%	491	498	513	528	549	551	546	559	556	522	486	486
60%	486	492	506	523	537	545	538	553	551	514	482	484
70%	483	485	499	514	531	534	529	548	544	504	479	483
80%	479	481	493	506	517	519	517	536	531	493	477	481
90%	475	475	483	490	496	496	503	510	510	479	467	477
Long Term												
Full Simulation Period ^b	493	500	513	527	538	542	539	553	552	524	494	491
Water Year Types^c												
Wet (23%)	494	502	527	547	558	562	538	556	574	565	528	512
Above Normal (24%)	494	502	516	536	555	562	551	570	572	541	497	487
Below Normal (10%)	490	502	511	524	540	542	539	552	550	521	488	487
Dry (16%)	498	507	516	526	533	535	546	556	545	505	479	487
Critical (27%)	488	490	497	503	508	511	526	533	518	486	472	482

Alternative 5												
Statistic	End of Month Elevation (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	515	524	546	561	561	568	570	577	577	571	530	515
20%	503	517	532	555	561	568	562	577	576	559	515	499
30%	498	512	525	540	561	567	557	568	573	543	498	493
40%	493	502	518	536	556	560	551	564	568	533	490	488
50%	491	498	513	528	549	551	546	559	556	522	486	486
60%	486	492	506	523	537	545	538	553	551	514	482	484
70%	483	485	499	514	531	534	529	548	544	504	479	483
80%	479	481	493	506	517	519	517	536	531	493	477	481
90%	475	475	483	490	496	496	503	510	510	479	467	477
Long Term												
Full Simulation Period ^b	493	500	513	527	538	542	539	553	552	524	494	491
Water Year Types^c												
Wet (23%)	494	502	527	547	558	562	538	556	574	565	528	512
Above Normal (24%)	494	502	516	536	555	562	551	570	572	541	497	487
Below Normal (10%)	490	502	511	524	540	542	539	552	550	521	488	487
Dry (16%)	498	507	516	526	533	535	546	556	545	505	479	487
Critical (27%)	488	490	497	503	508	511	526	533	518	486	472	482

Alternative 5 minus Second Basis of Comparison												
Statistic	End of Month Elevation (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types^c												
Wet (23%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (10%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (27%)	0	0	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1 **C.15. Delta Outflow**


Figure C-15-1-1. Sacramento/San Joaquin River Delta Outflow, Long-Term* Average Flow

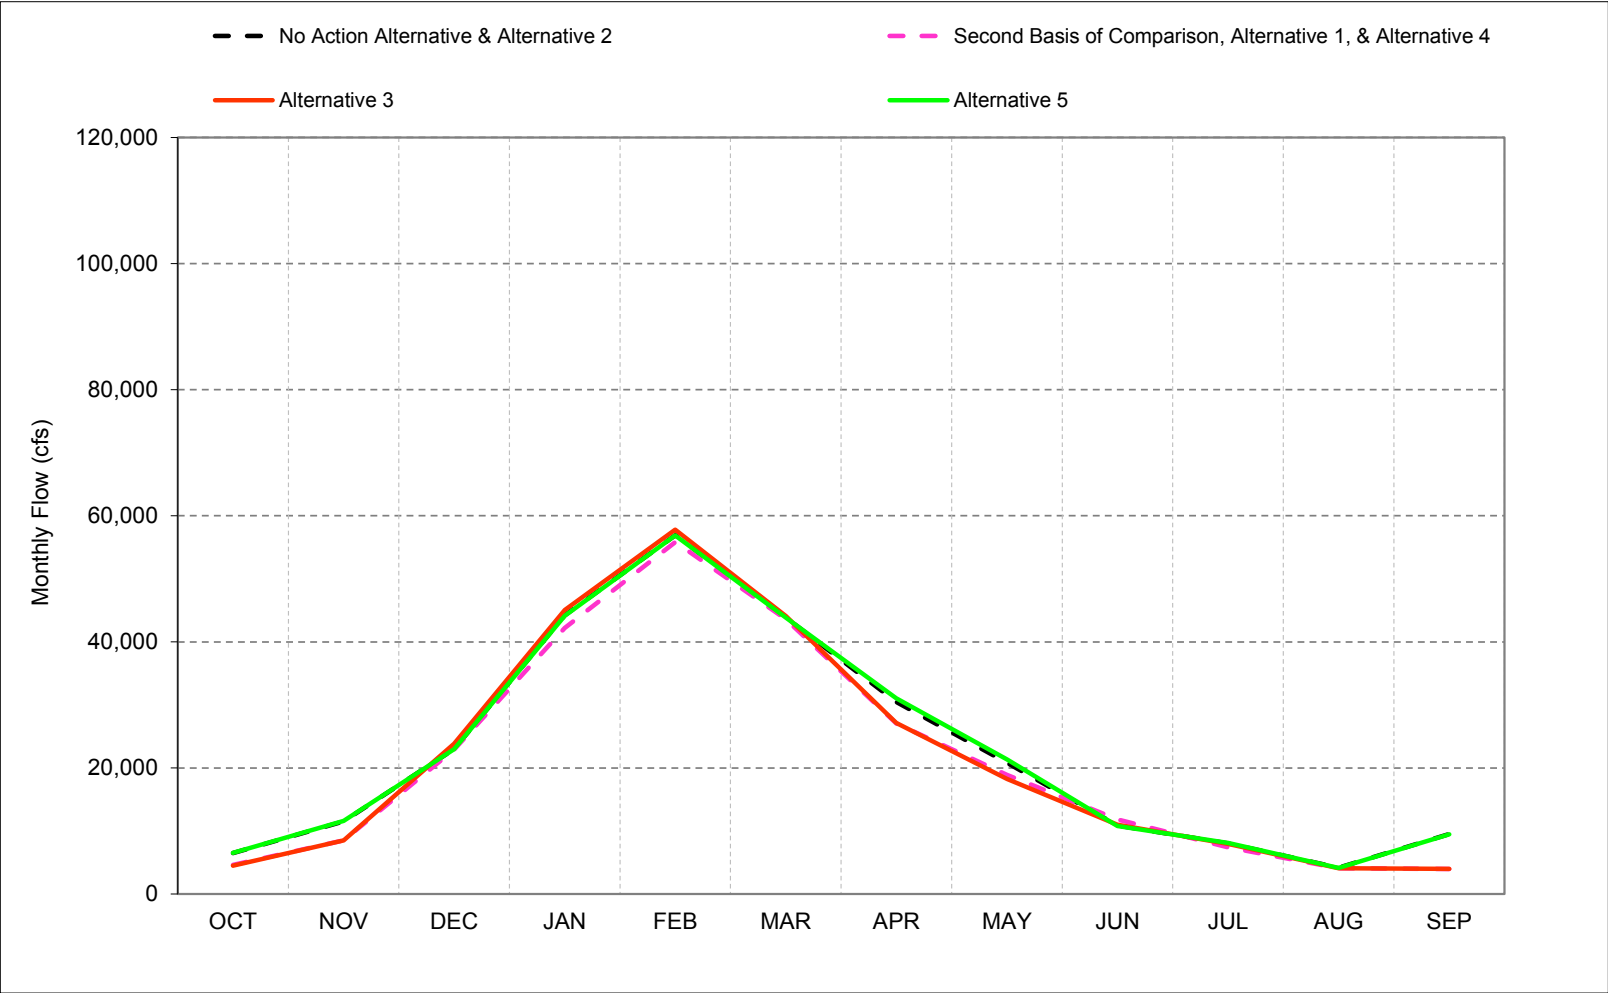

*Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-15-1-2. Sacramento/San Joaquin River Delta Outflow, Wet Year* Long-Term** Average Flow

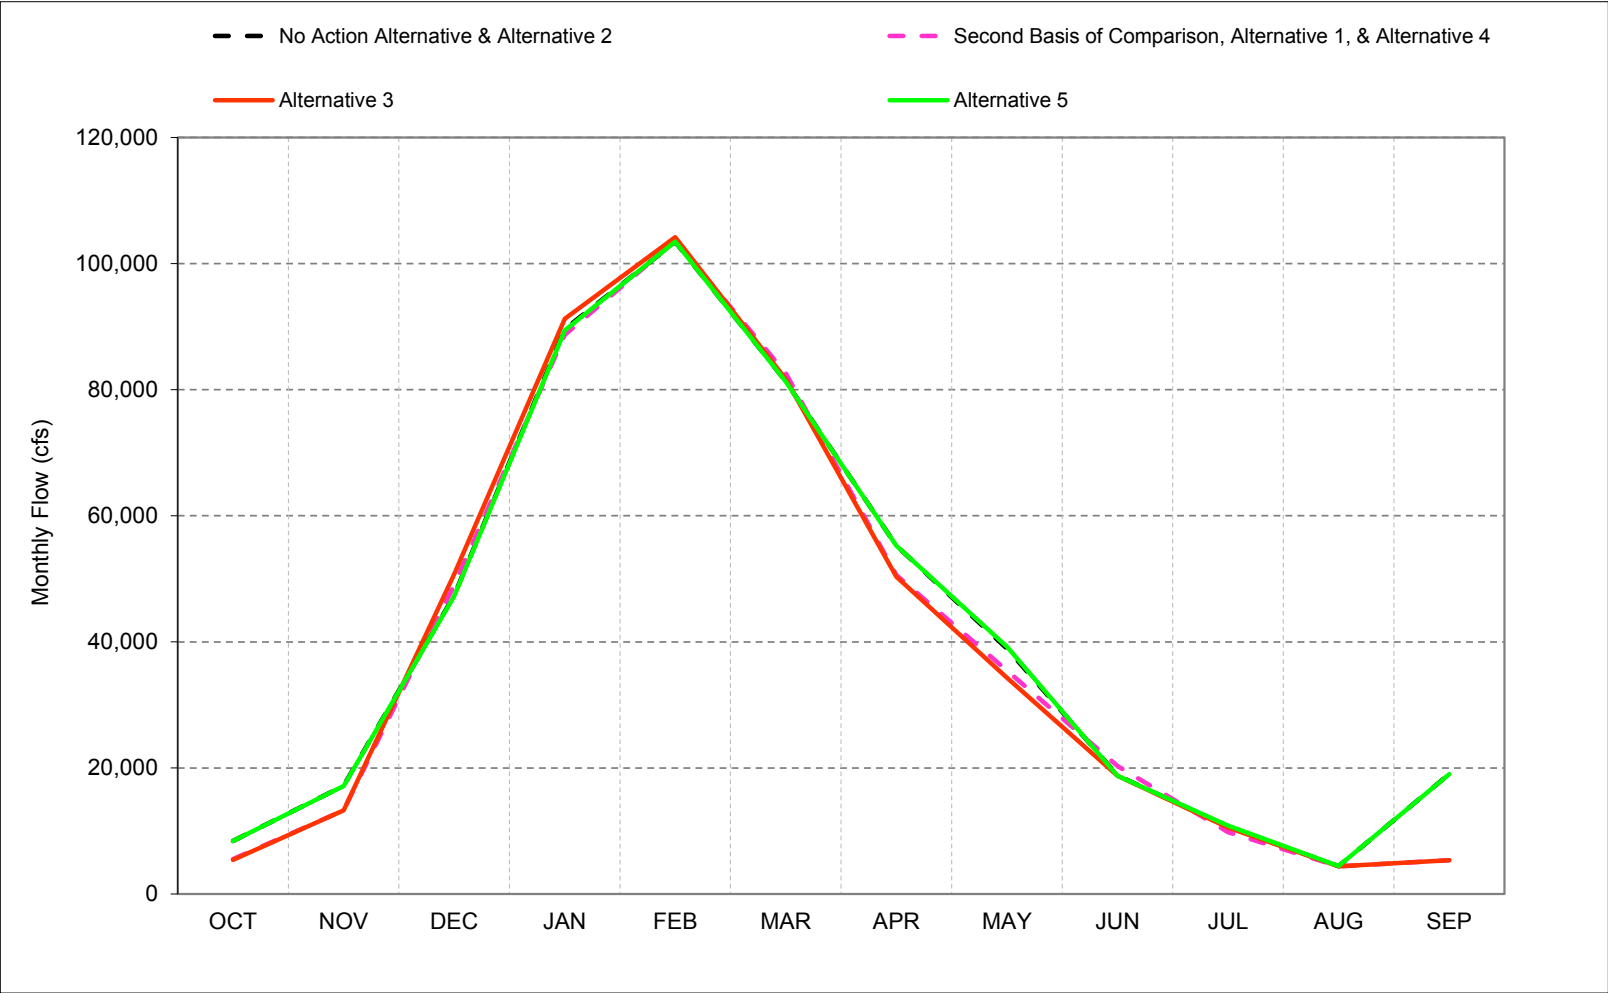


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-15-1-3. Sacramento/San Joaquin River Delta Outflow, Above Normal Year* Long-Term** Average Flow

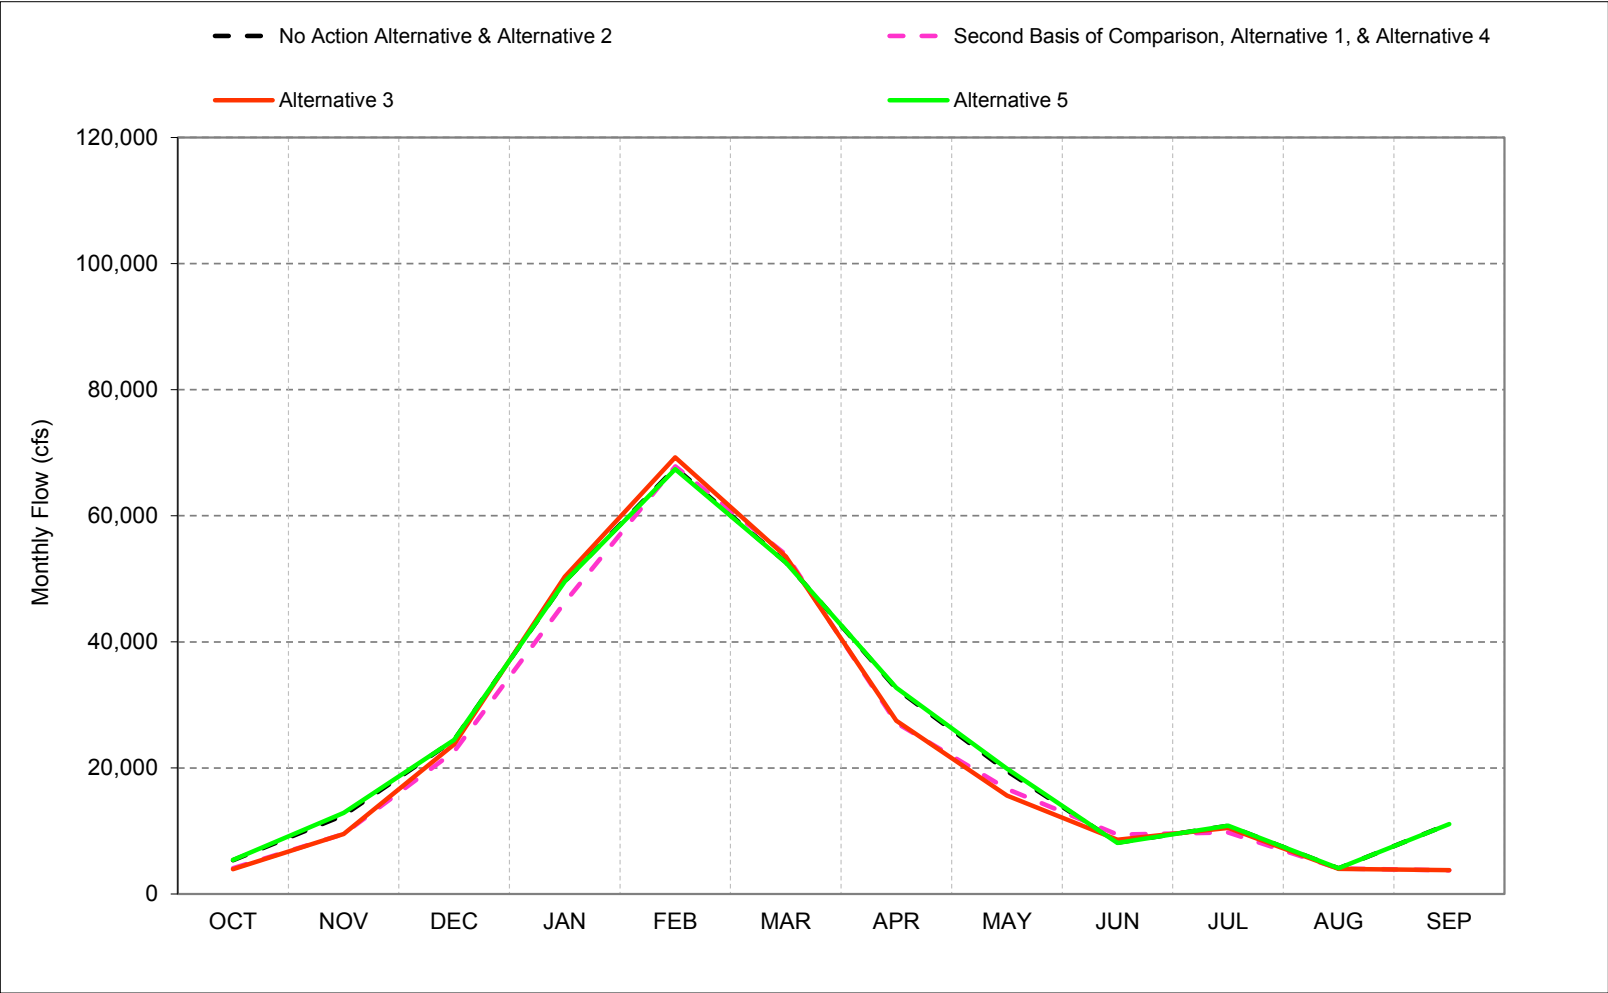


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-15-1-4. Sacramento/San Joaquin River Delta Outflow, Below Normal Year* Long-Term** Average Flow

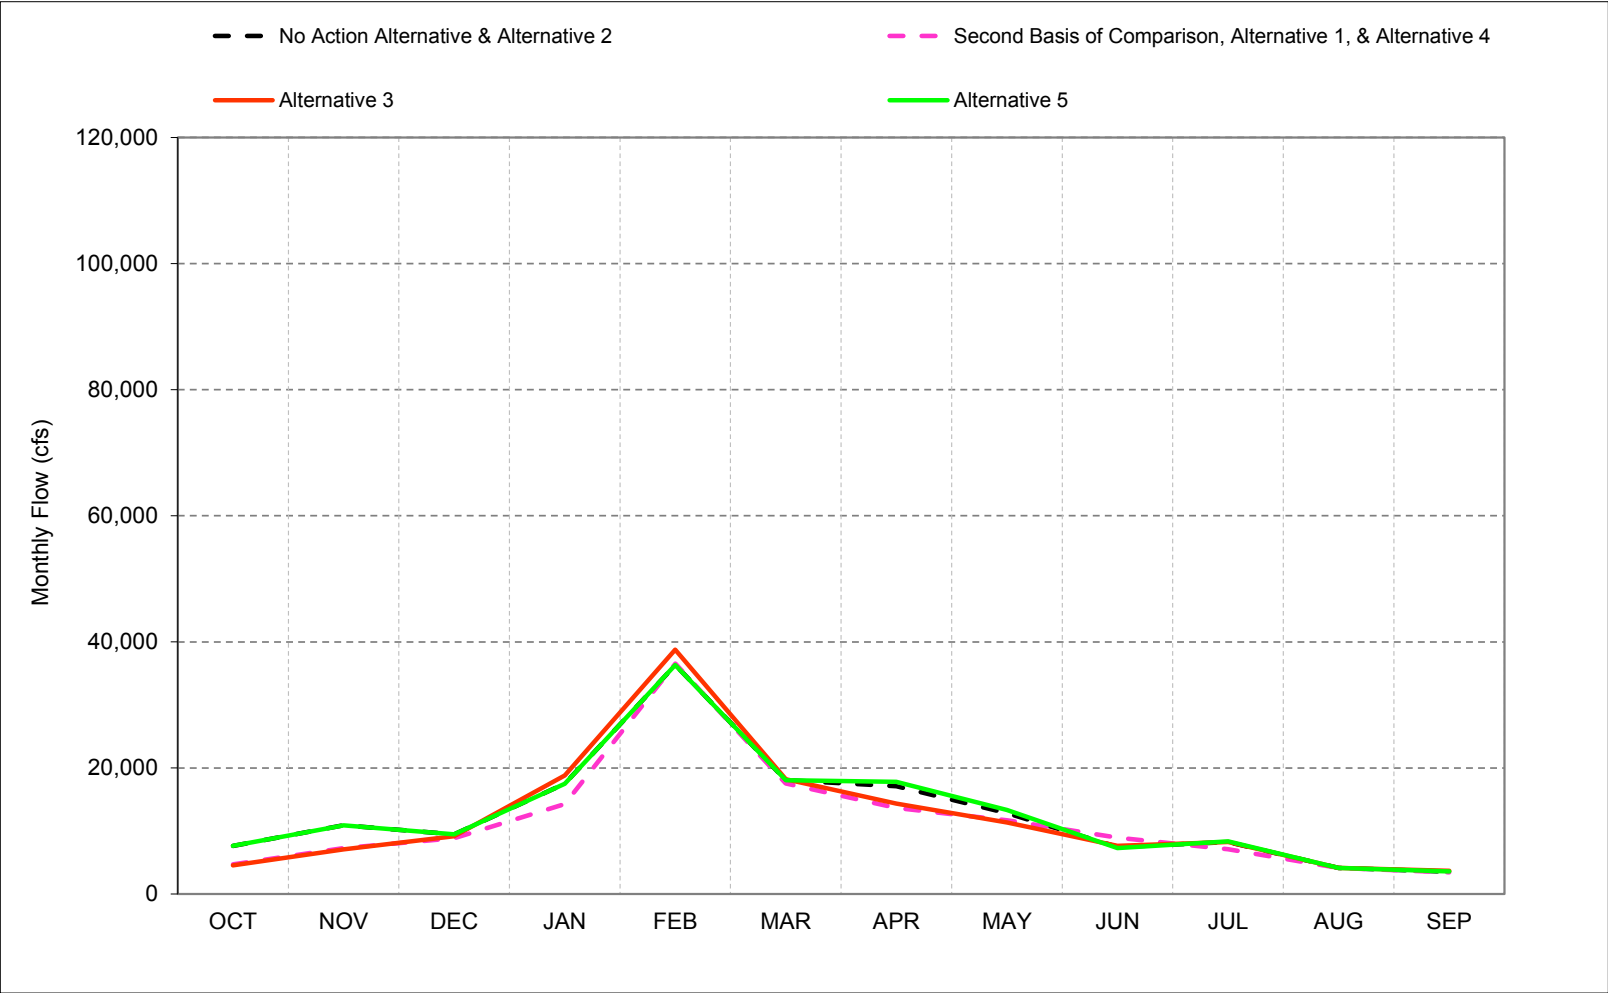


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-15-1-5. Sacramento/San Joaquin River Delta Outflow, Dry Year* Long-Term** Average Flow

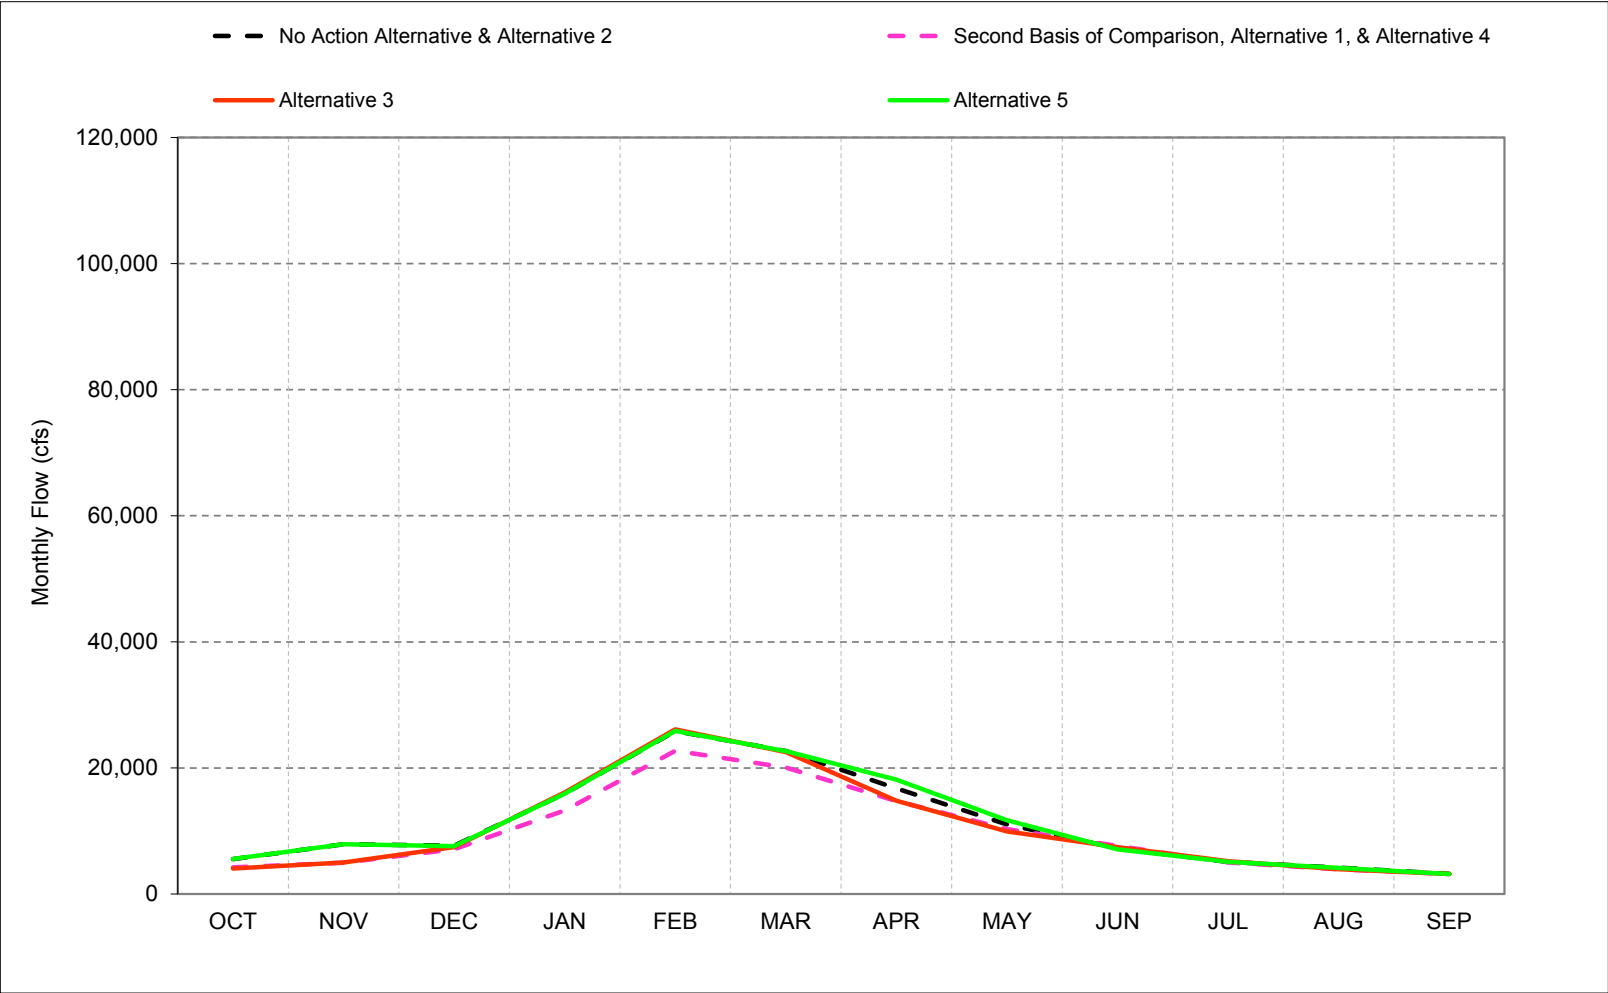


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-15-1-6. Sacramento/San Joaquin River Delta Outflow, Critical Year* Long-Term** Average Flow

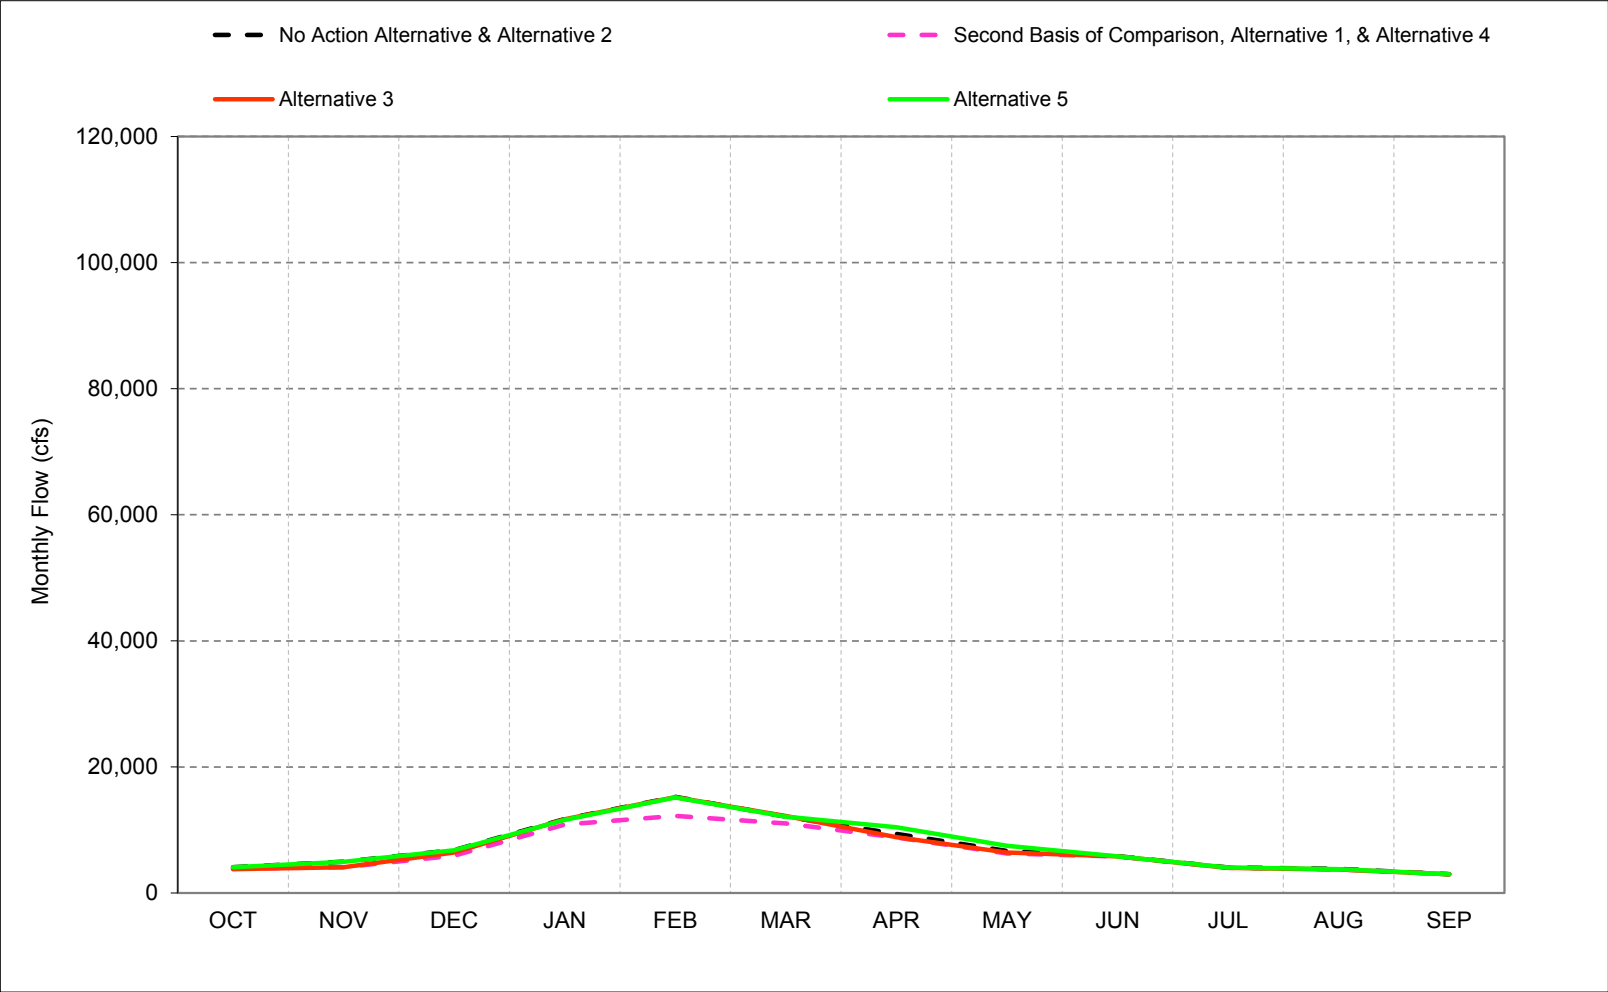


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-15-2-1. Sacramento/San Joaquin River Delta Outflow, October

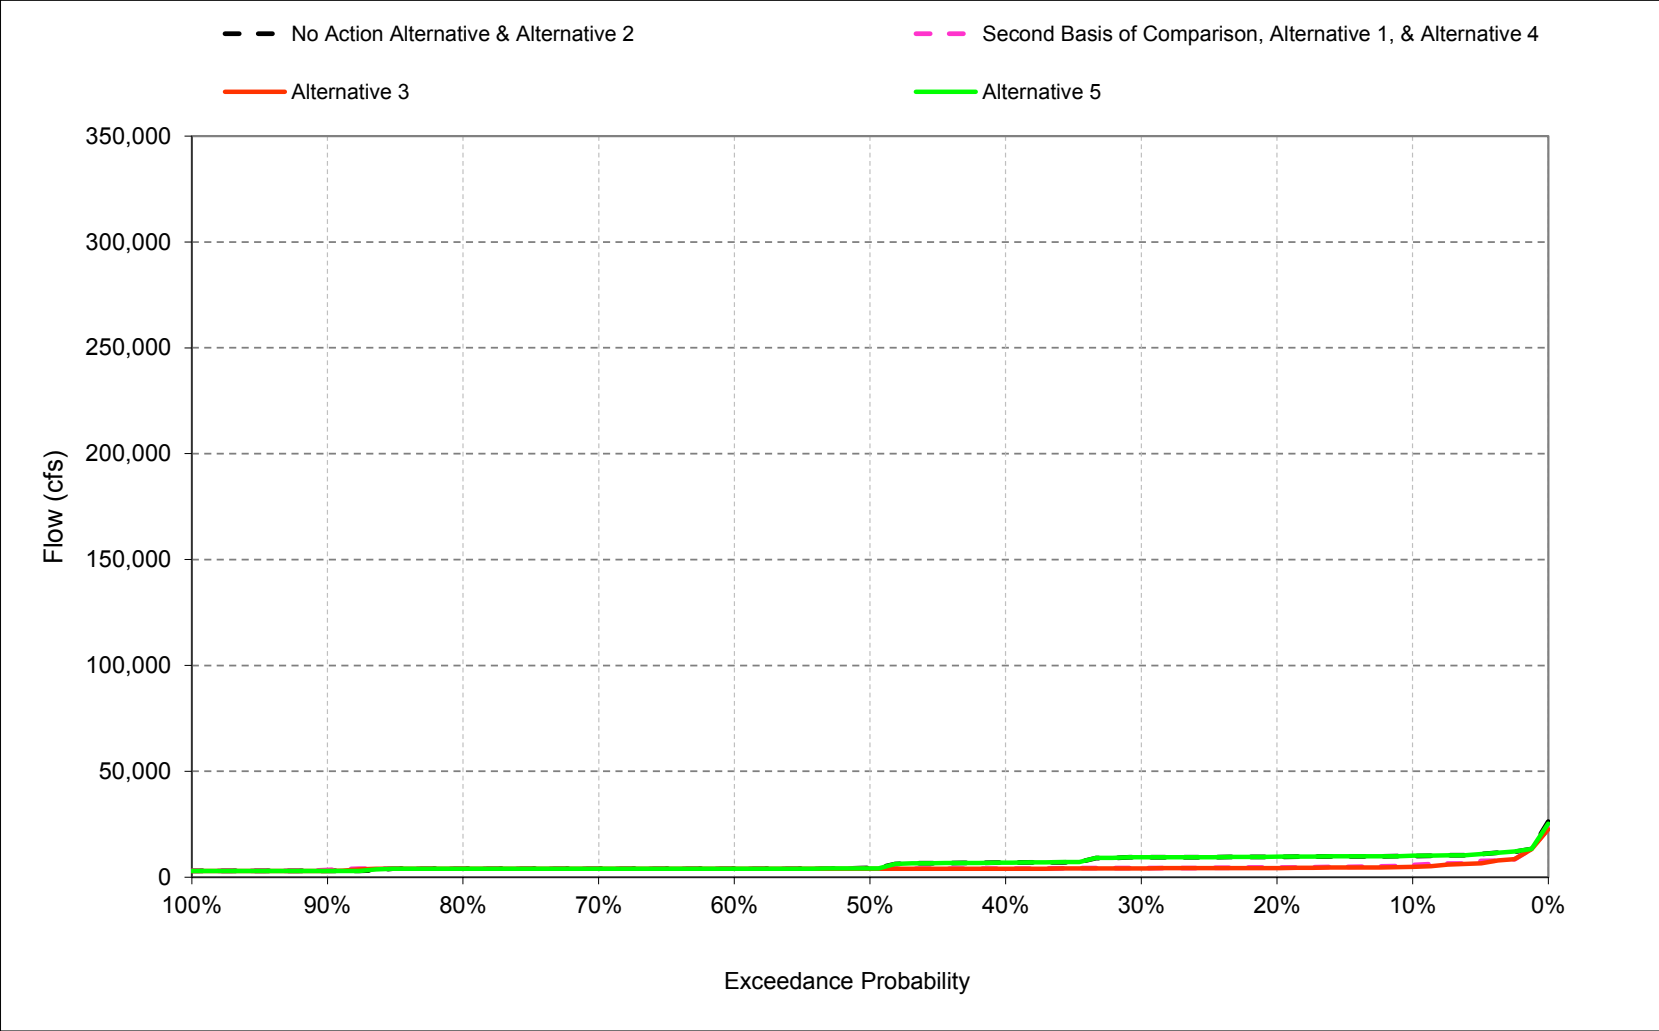


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-15-2-2. Sacramento/San Joaquin River Delta Outflow, November

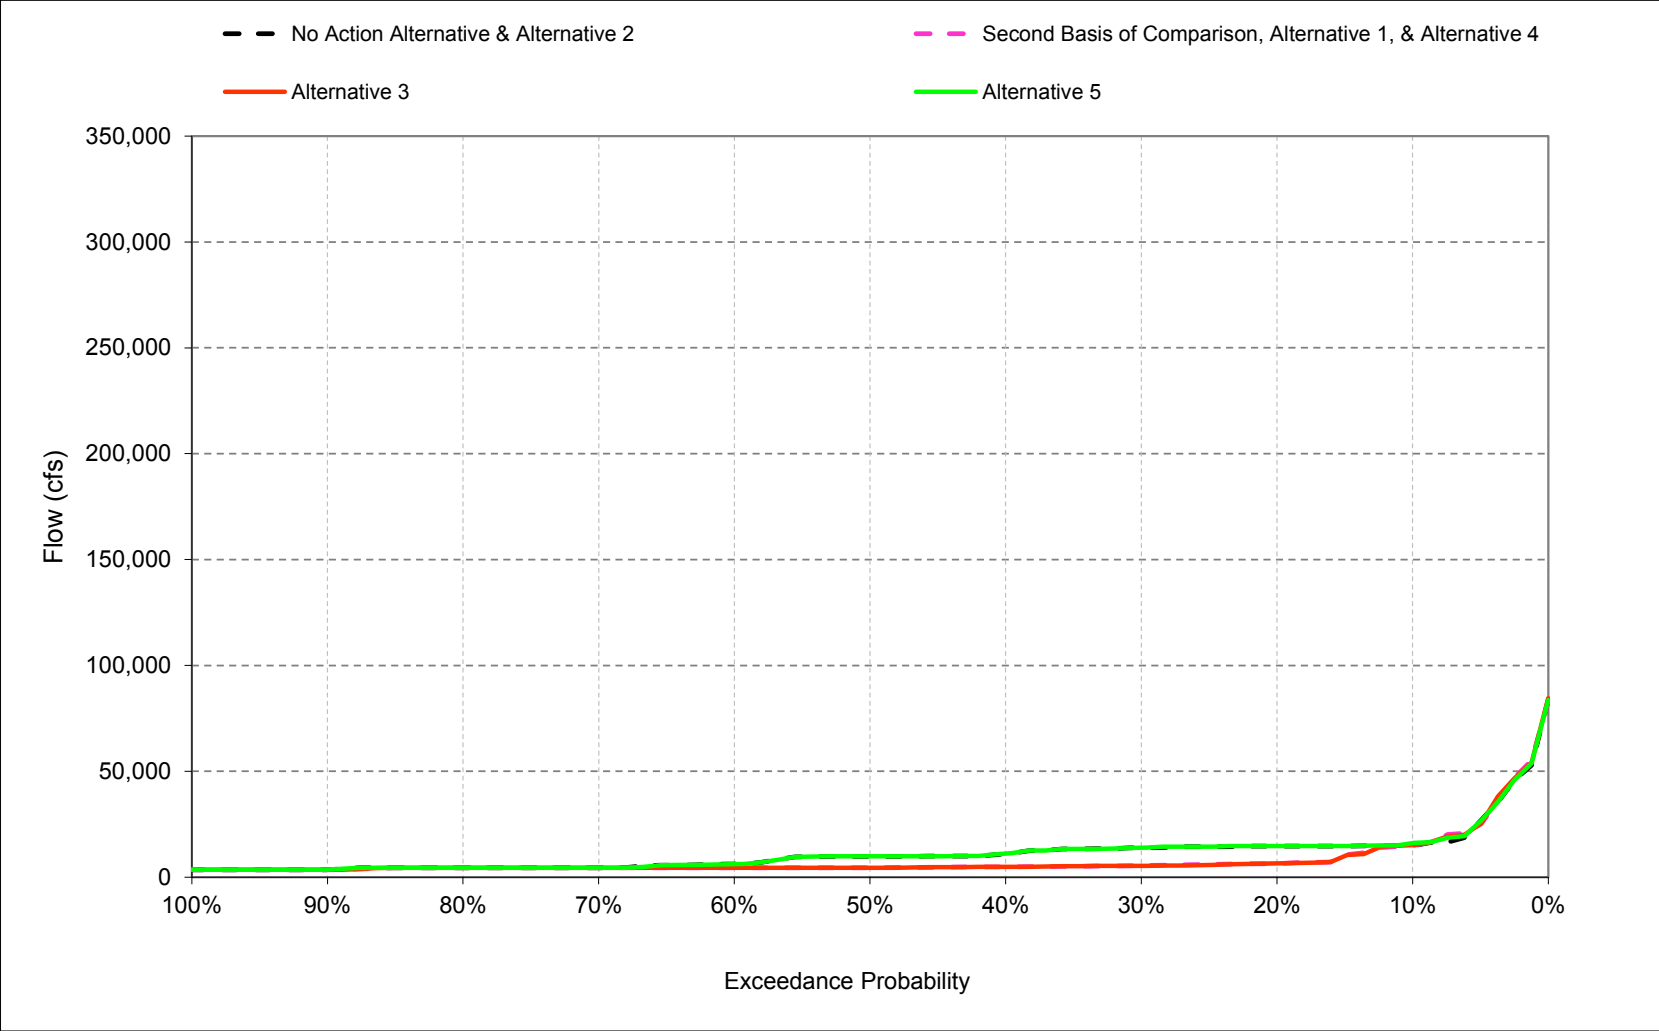


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-15-2-3. Sacramento/San Joaquin River Delta Outflow, December

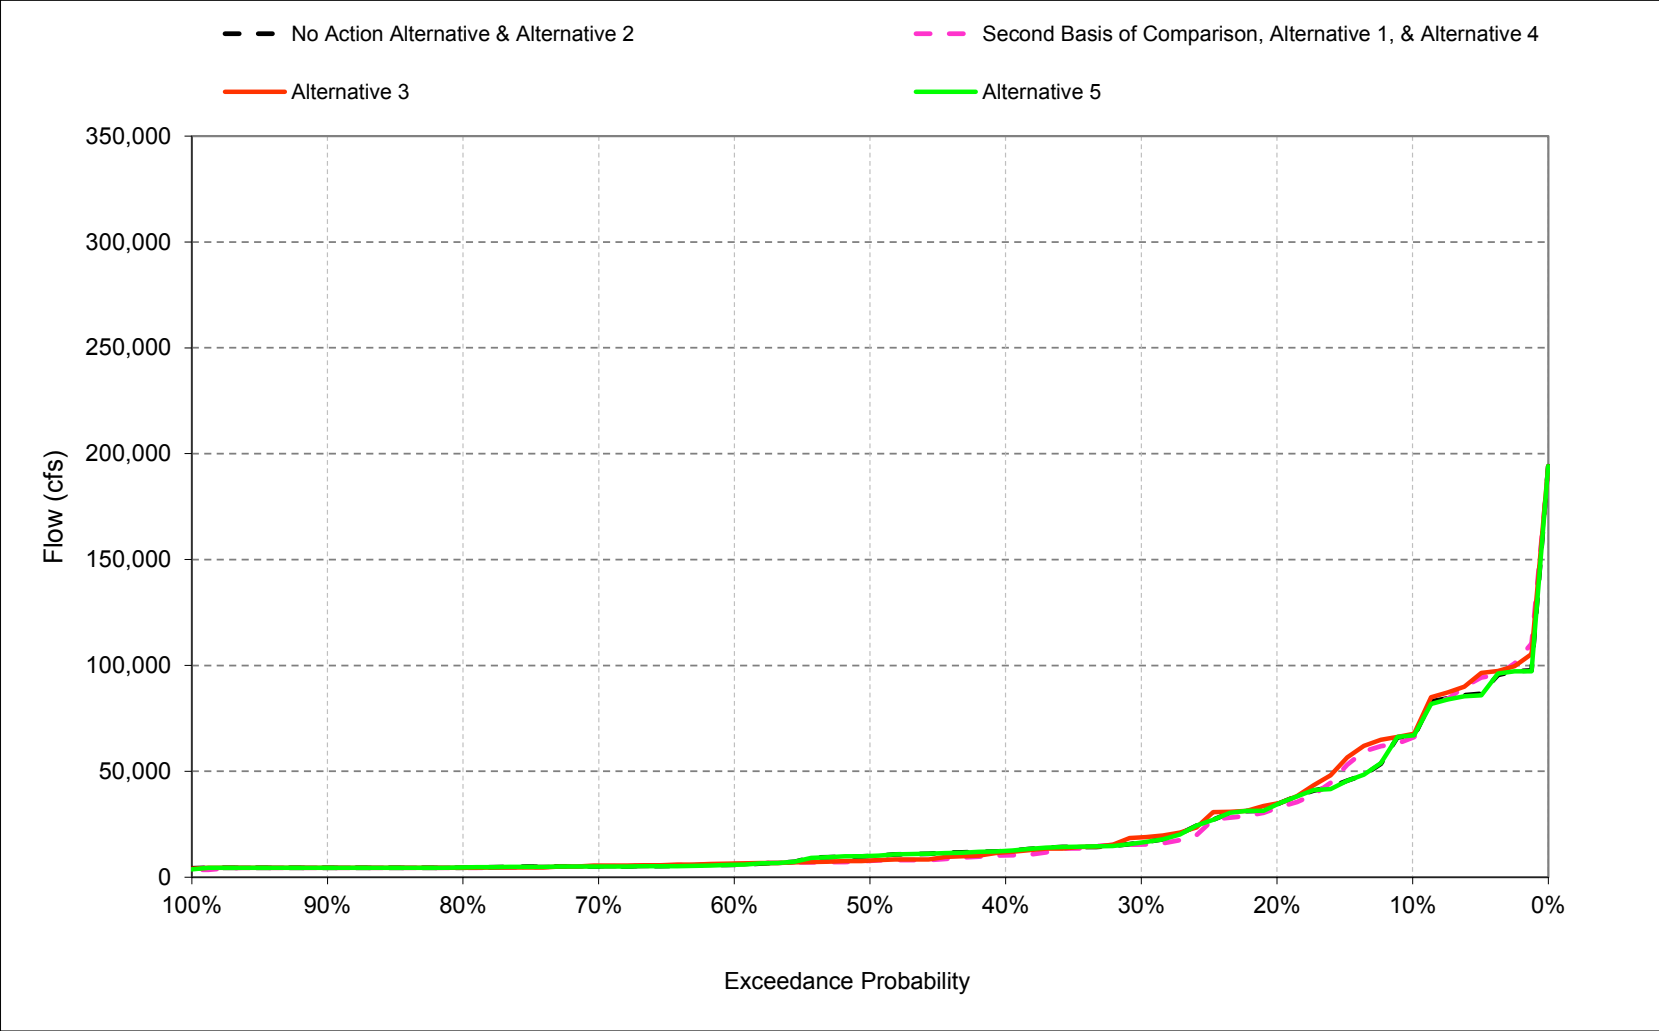


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-15-2-4. Sacramento/San Joaquin River Delta Outflow, January

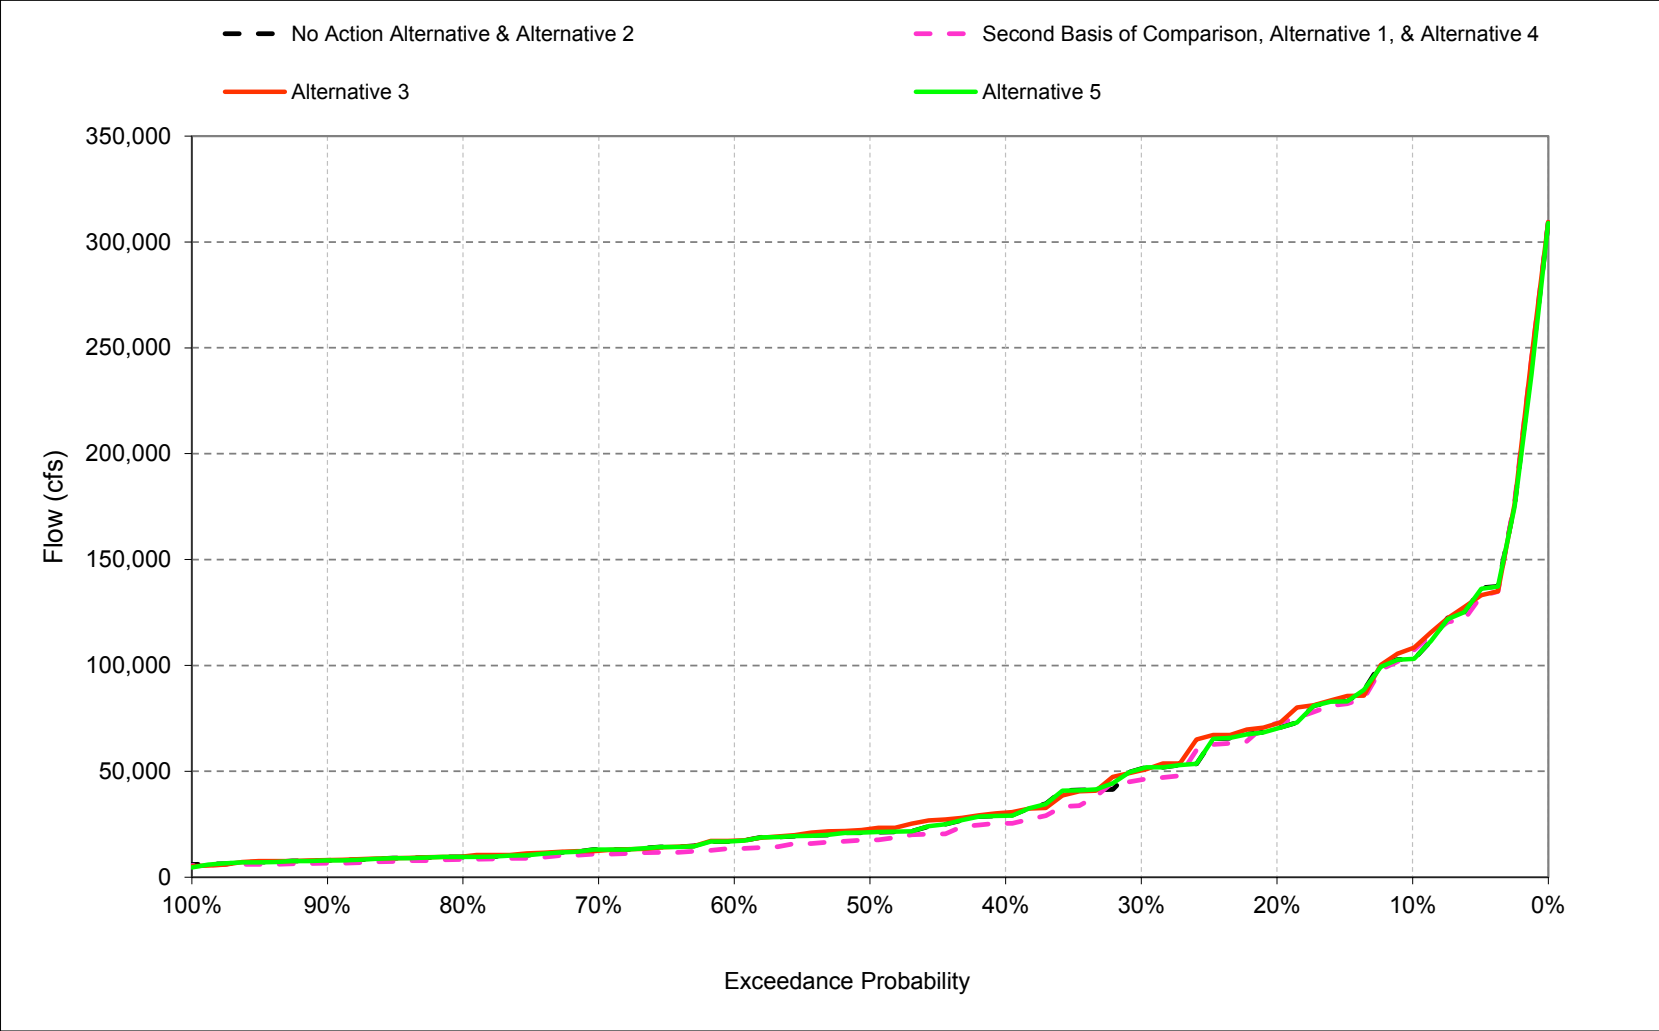


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-15-2-5. Sacramento/San Joaquin River Delta Outflow, February

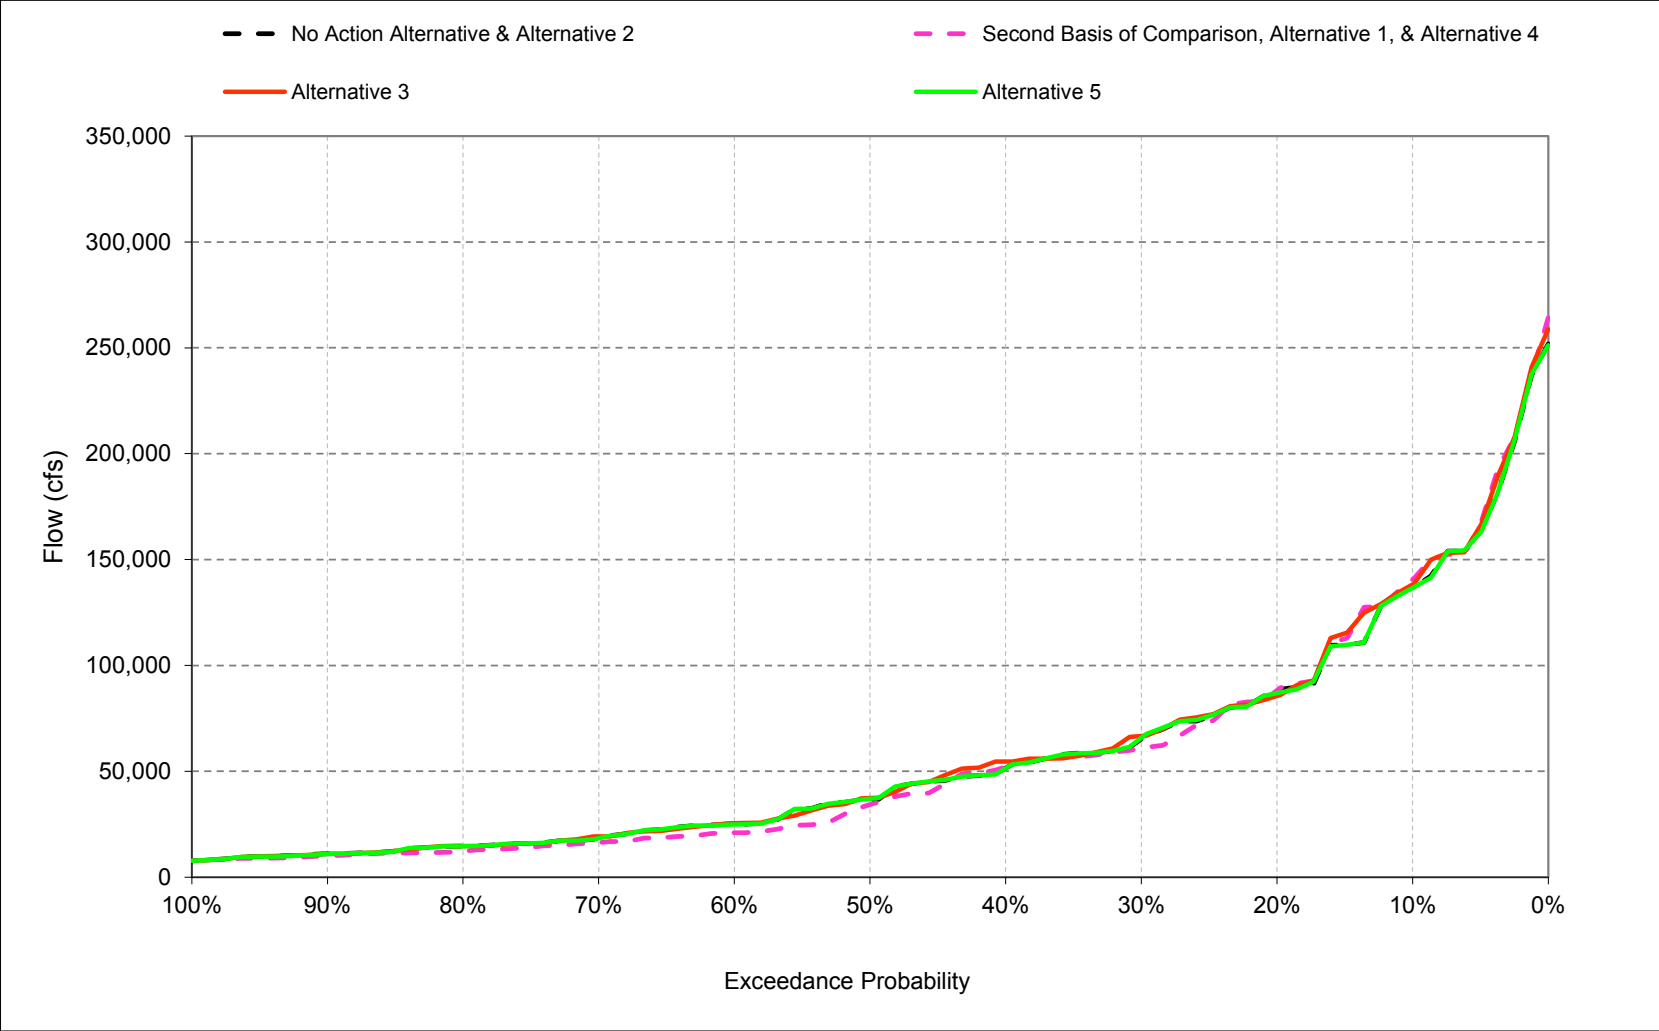


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-15-2-6. Sacramento/San Joaquin River Delta Outflow, March

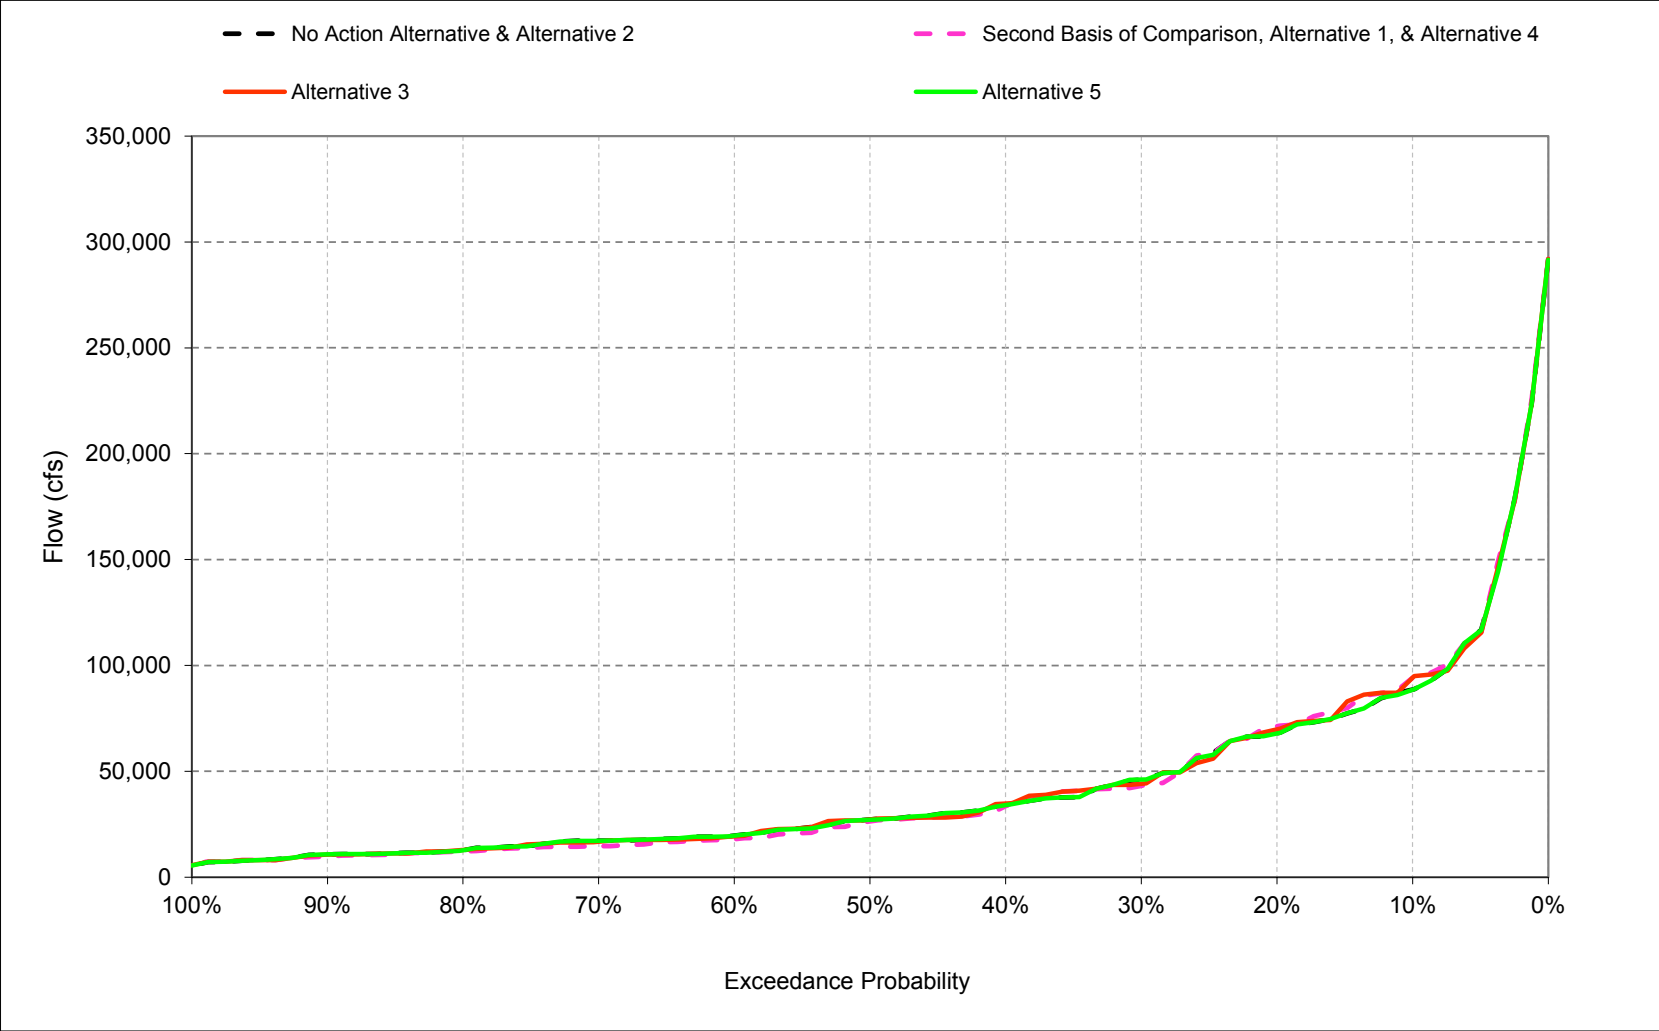


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-15-2-7. Sacramento/San Joaquin River Delta Outflow, April

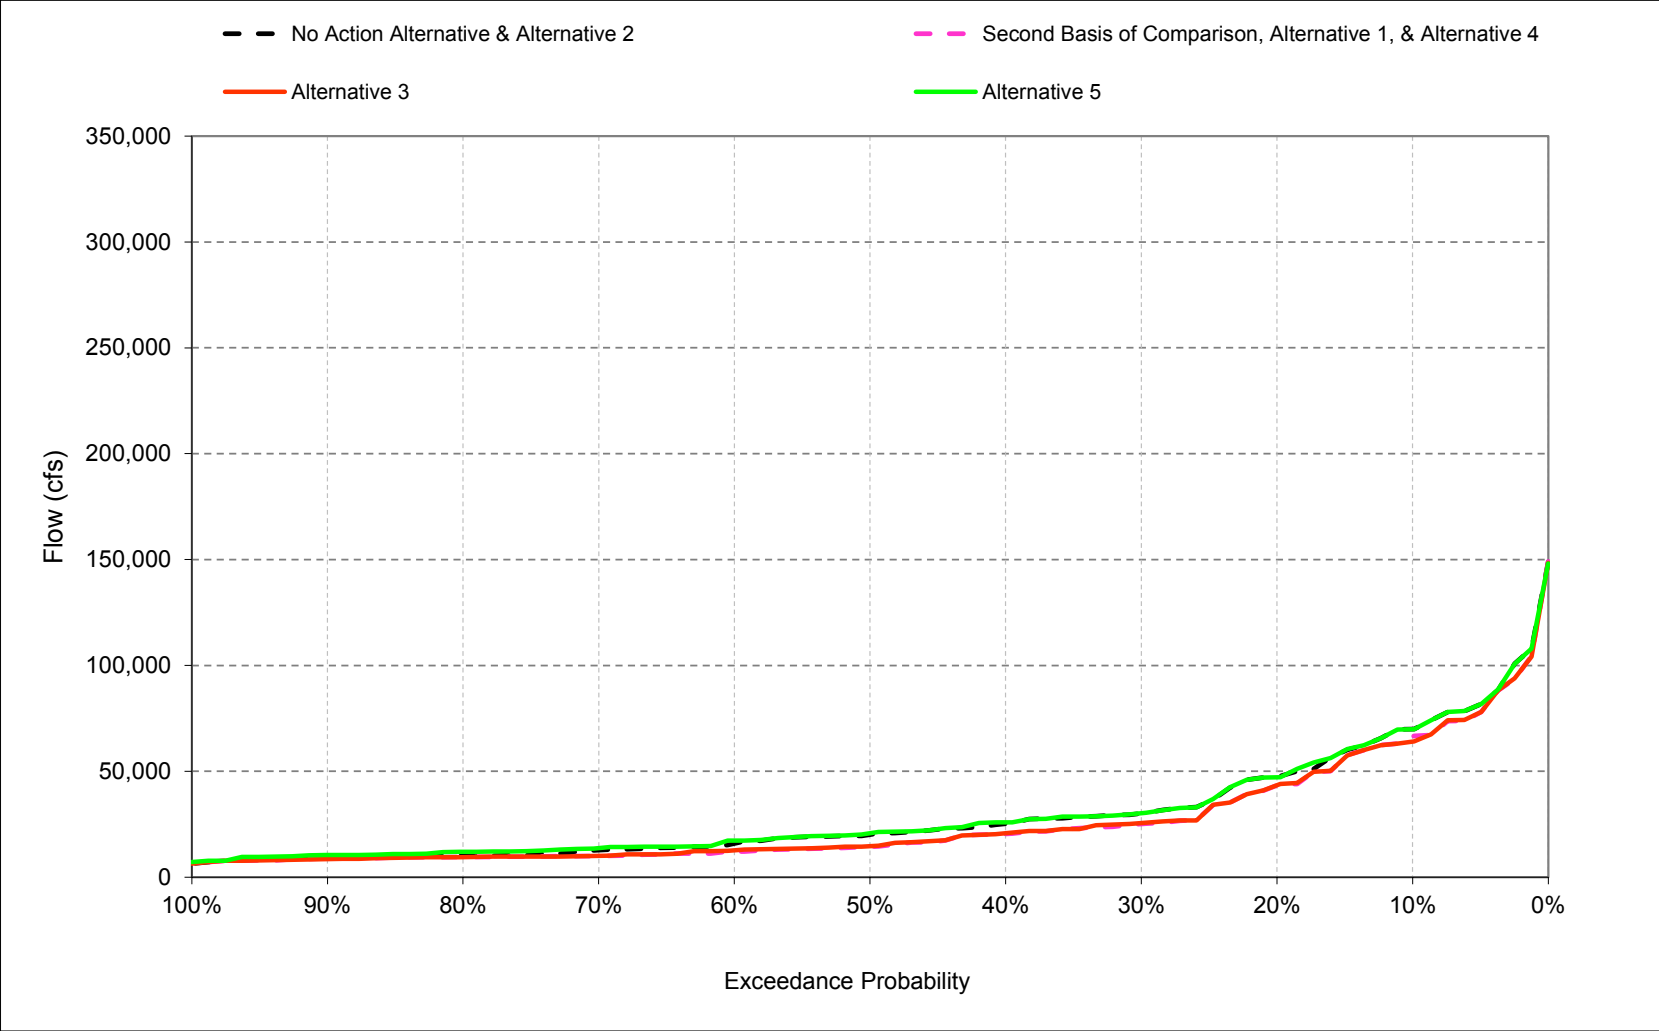


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-15-2-8. Sacramento/San Joaquin River Delta Outflow, May

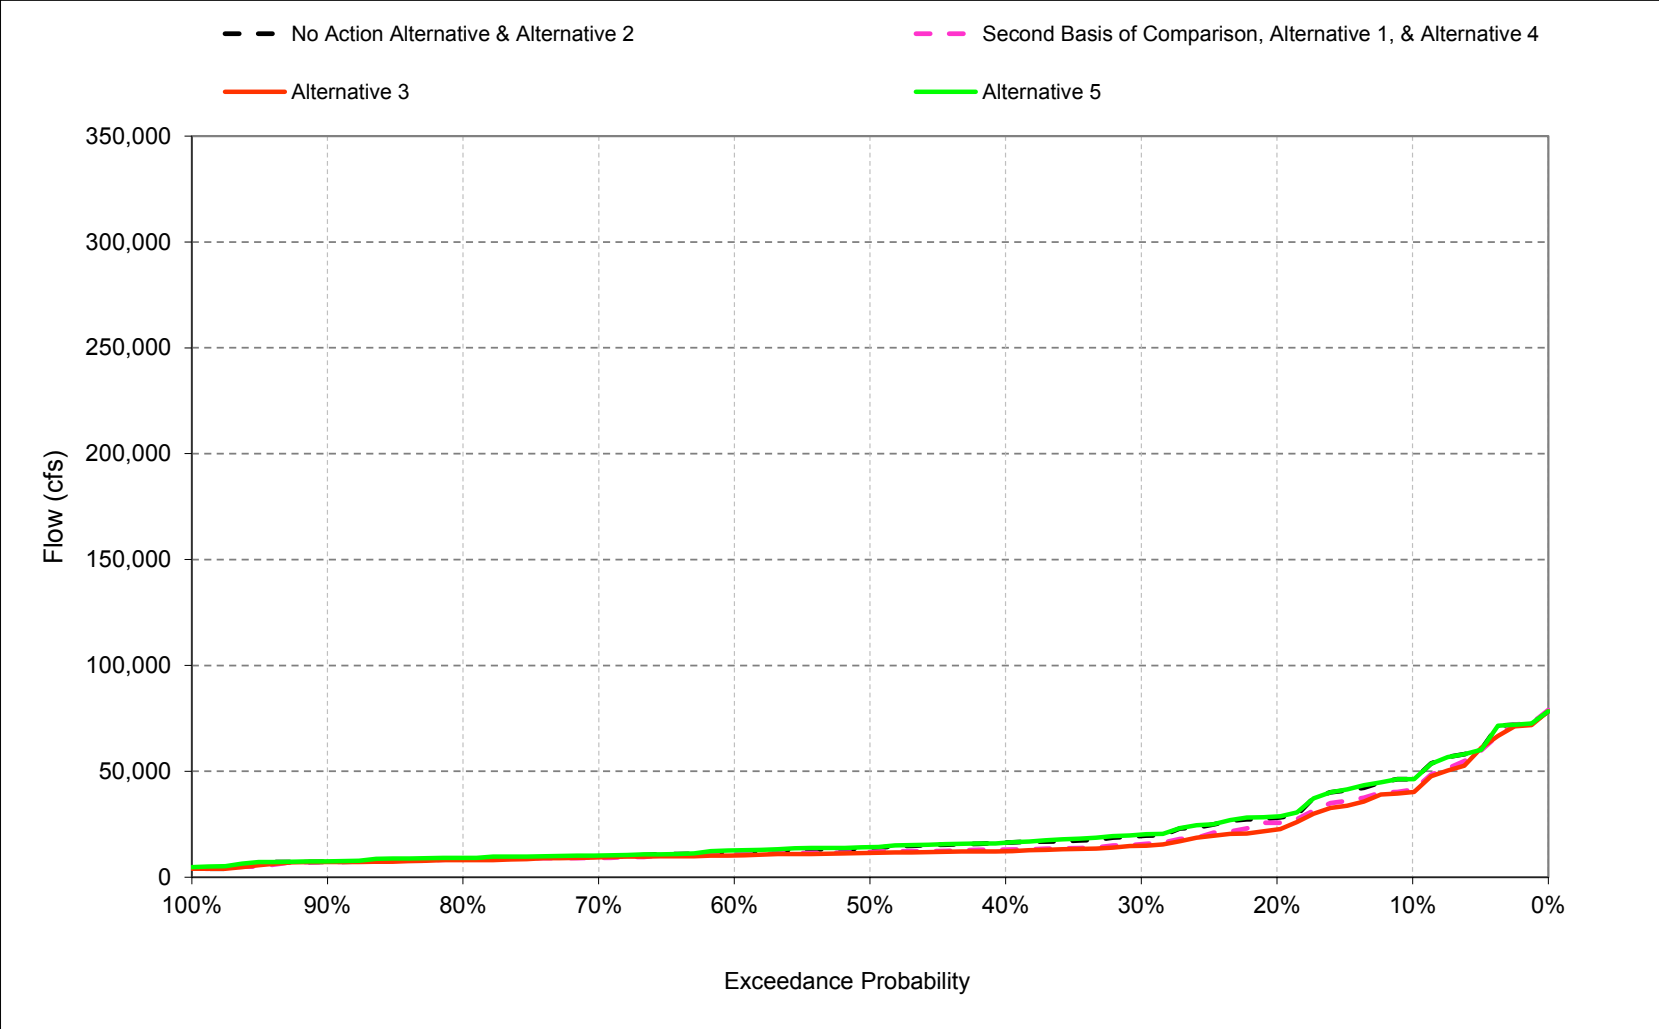


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-15-2-9. Sacramento/San Joaquin River Delta Outflow, June

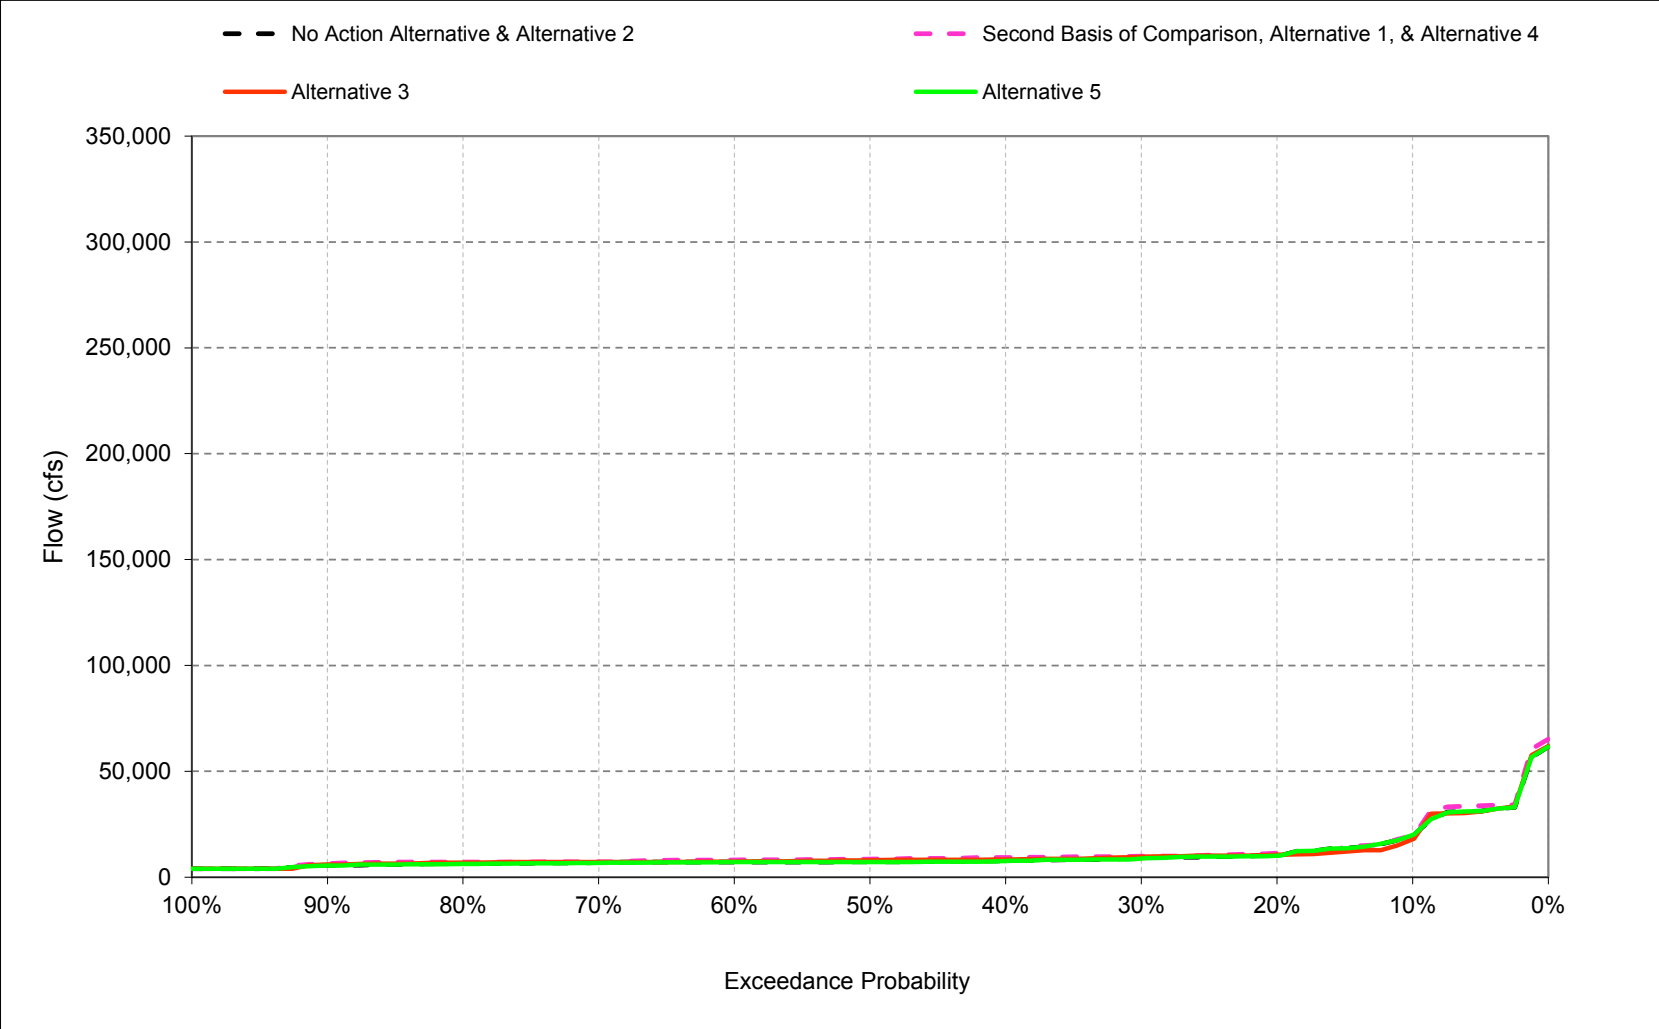


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-15-2-10. Sacramento/San Joaquin River Delta Outflow, July

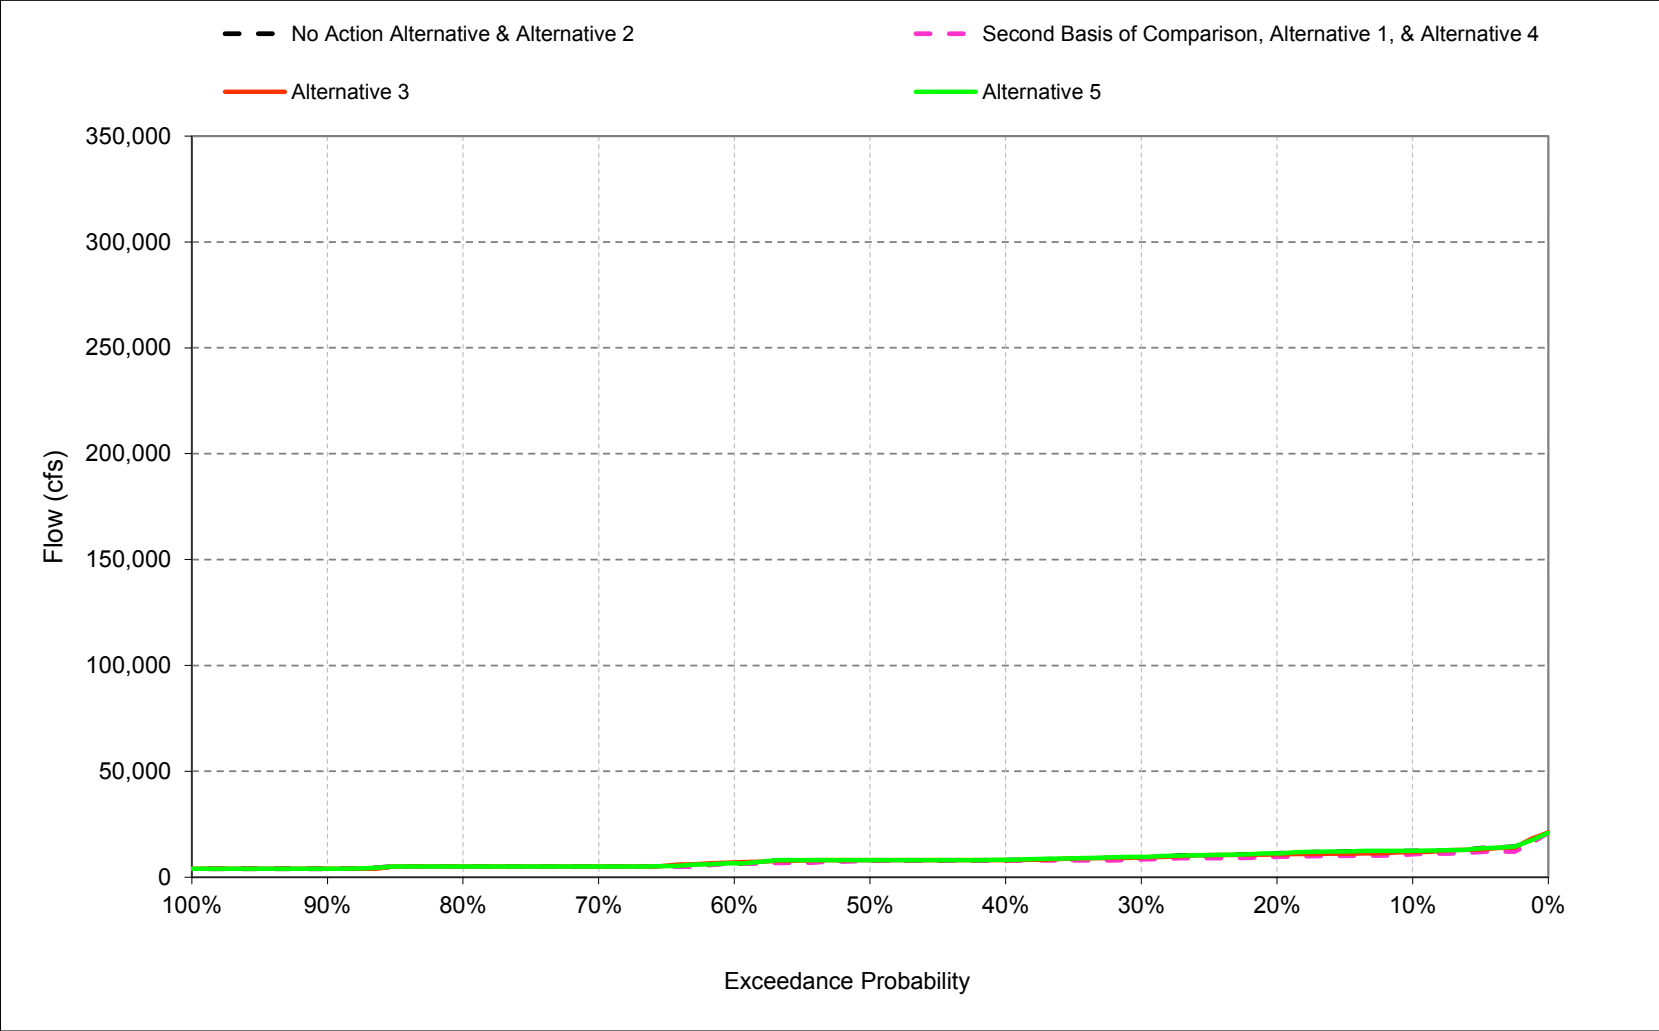


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-15-2-11. Sacramento/San Joaquin River Delta Outflow, August

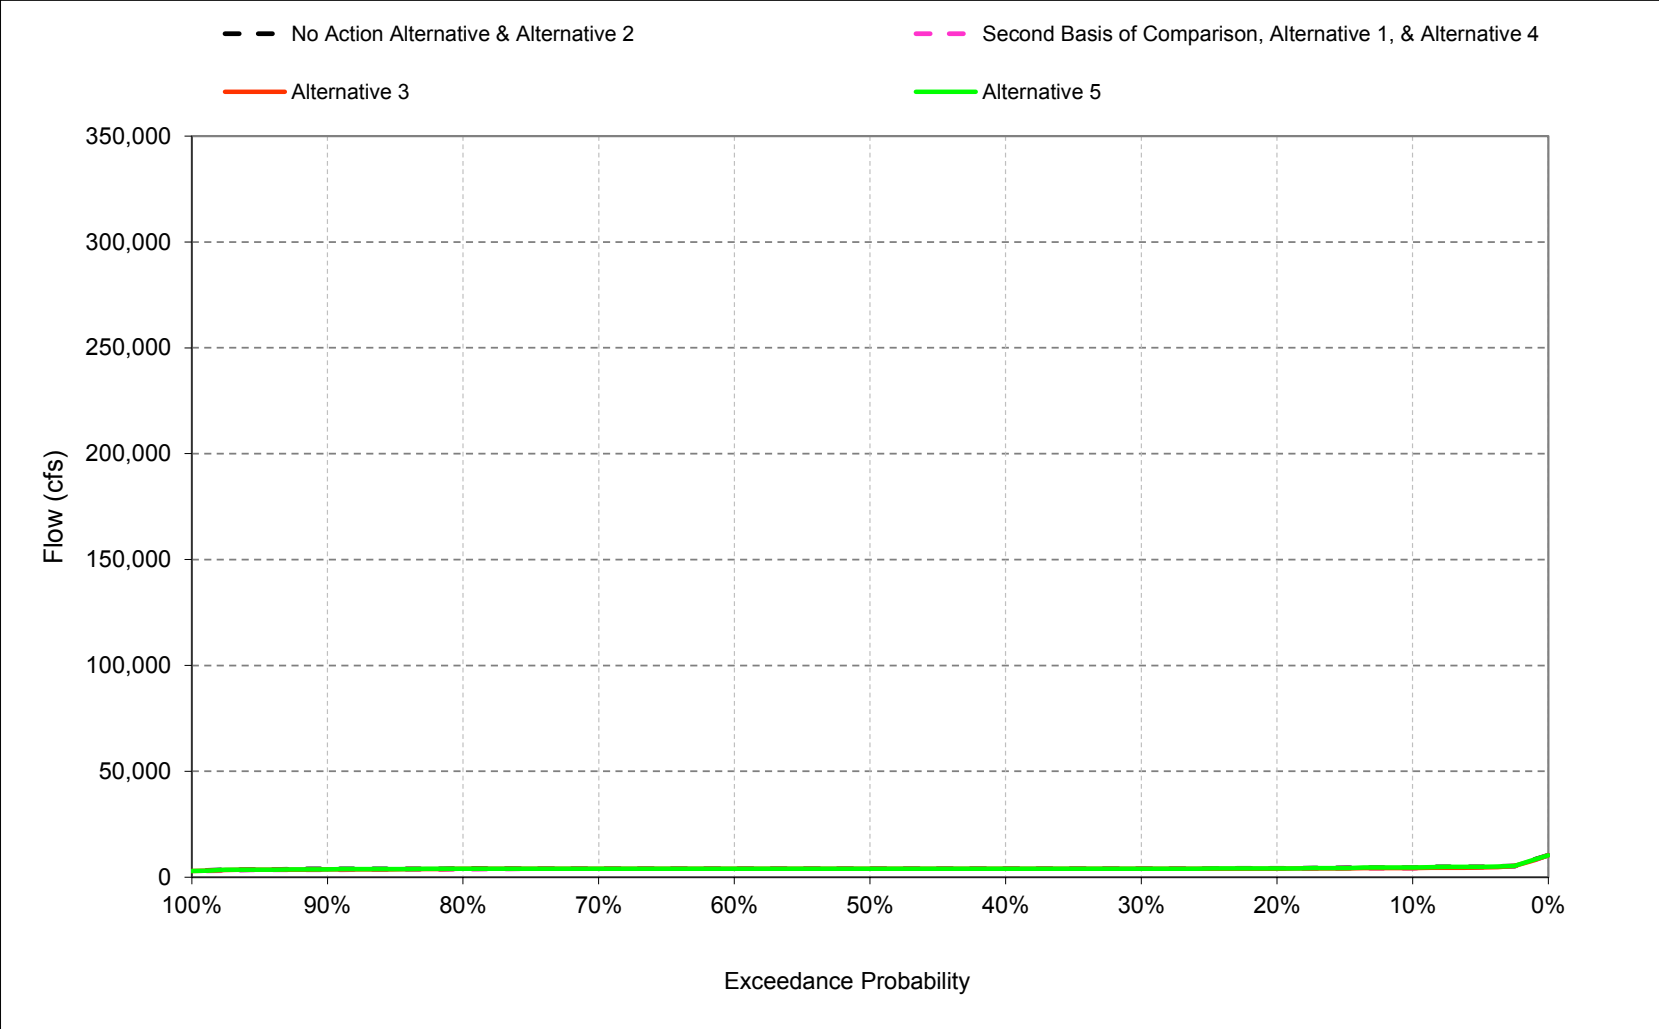

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-15-2-12. Sacramento/San Joaquin River Delta Outflow, September

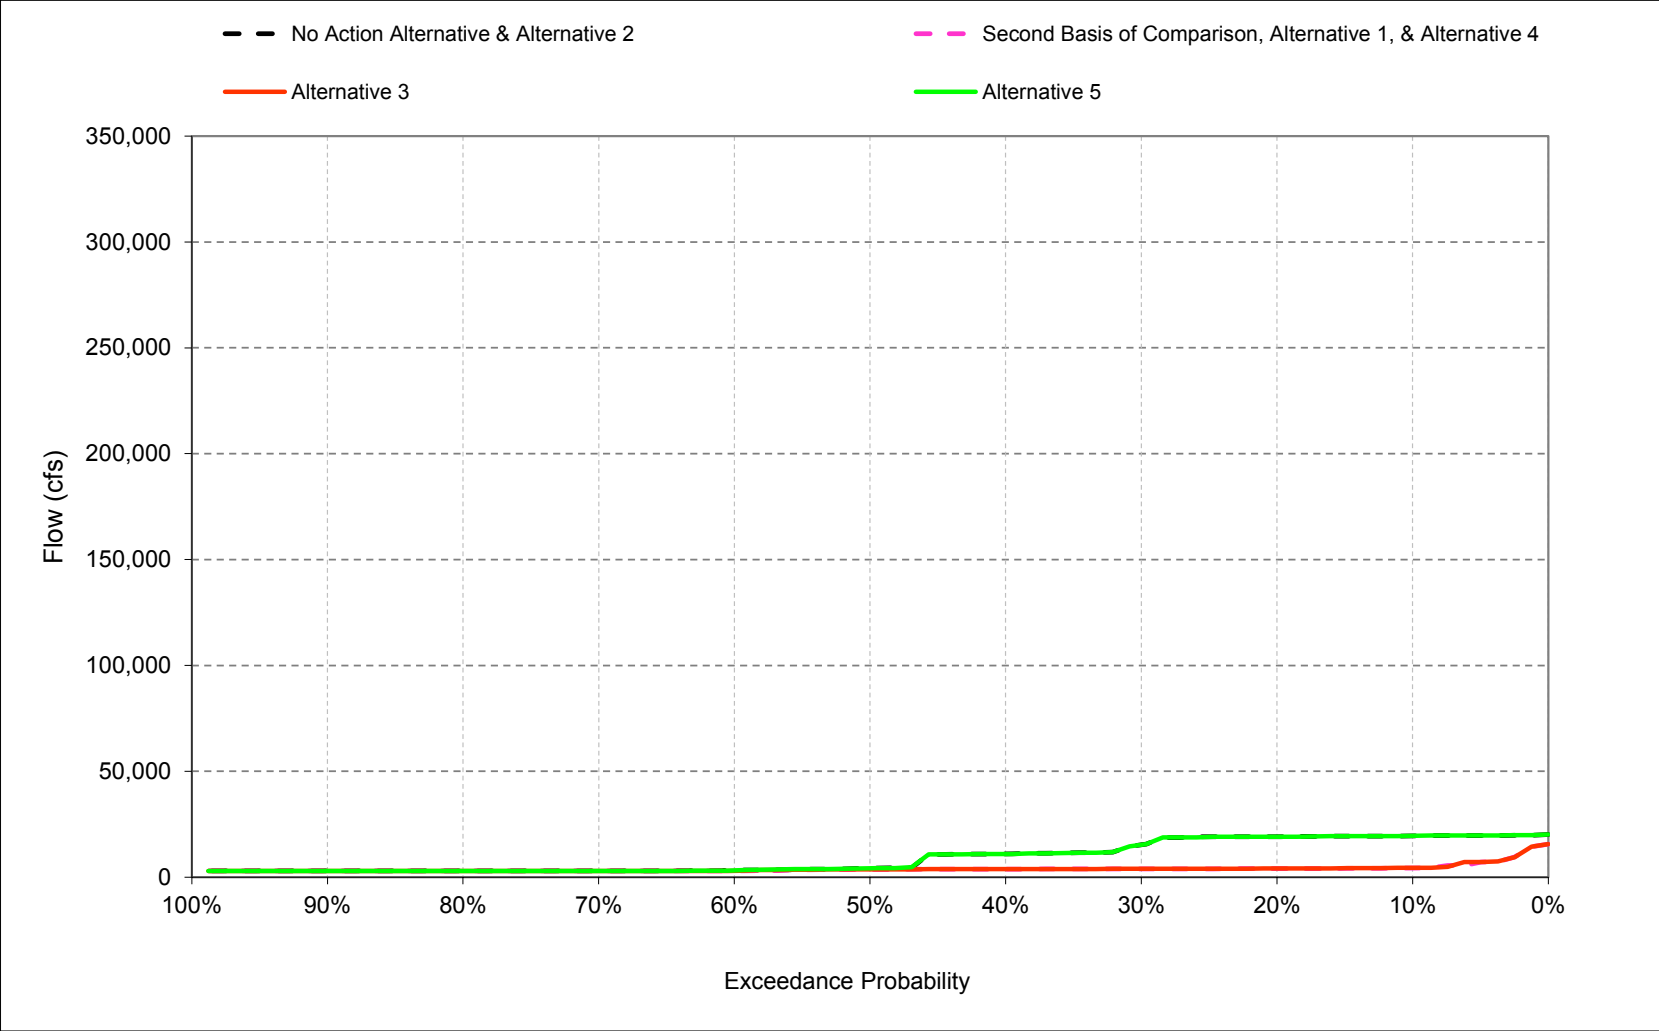

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-15-1-1. Sacramento/San Joaquin River Delta Outflow, Monthly Outflow Rate

No Action Alternative												
Statistic	Monthly Outflow Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	9,992	15,000	66,586	102,991	136,665	88,553	69,913	46,324	19,838	12,406	4,507	19,516
20%	9,531	14,688	34,349	70,303	88,107	67,957	47,628	28,079	10,238	11,185	4,216	19,063
30%	9,375	13,860	16,305	51,208	65,254	46,096	30,159	19,514	9,204	9,315	4,000	15,282
40%	6,875	11,037	12,381	29,158	51,473	34,027	25,272	16,321	7,814	8,085	4,000	11,031
50%	4,392	9,844	9,938	21,131	36,676	27,251	20,111	13,711	7,243	8,000	4,000	4,385
60%	4,000	6,183	5,835	17,085	24,952	19,582	15,896	11,883	7,100	6,500	4,000	3,376
70%	4,000	4,500	5,118	13,018	18,411	17,261	12,735	9,629	6,864	5,000	4,000	3,000
80%	4,000	4,500	4,522	9,524	14,648	12,732	10,054	8,460	6,435	5,000	4,000	3,000
90%	3,000	3,537	4,500	7,899	11,020	10,766	9,479	7,246	5,606	4,002	3,899	3,000
Long Term												
Full Simulation Period ^b	6,518	11,533	23,026	44,232	56,916	43,869	30,448	20,838	10,885	8,050	4,189	9,501
Water Year Types^c												
Wet (32%)	8,450	17,141	47,372	89,598	103,413	81,313	55,257	38,940	18,827	10,658	4,436	19,044
Above Normal (16%)	5,392	12,471	24,425	49,593	67,594	52,635	32,571	19,525	8,150	10,846	4,084	11,130
Below Normal (13%)	7,664	10,918	9,460	17,510	36,331	18,095	17,124	12,827	7,473	8,256	4,136	3,549
Dry (24%)	5,547	7,902	7,667	15,952	25,846	22,699	16,782	11,064	7,243	5,131	4,182	3,208
Critical (15%)	4,118	4,980	6,796	11,761	15,260	12,156	9,387	6,671	5,840	4,045	3,829	3,000

Alternative 1												
Statistic	Monthly Outflow Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	5,803	15,044	65,929	106,799	140,602	94,253	66,380	41,321	19,611	10,902	4,356	4,374
20%	4,603	6,436	32,639	72,700	88,242	71,240	43,356	25,729	11,405	9,646	4,087	4,037
30%	4,296	5,501	15,458	45,999	60,904	43,140	25,102	15,512	9,888	8,374	4,000	3,937
40%	4,085	4,892	10,325	25,436	52,110	33,538	20,427	13,024	9,349	8,000	4,000	3,819
50%	4,000	4,500	7,764	17,566	34,276	26,362	14,374	11,939	8,527	7,726	4,000	3,682
60%	4,000	4,500	6,206	13,540	21,001	17,962	12,164	10,966	8,142	6,500	4,000	3,034
70%	4,000	4,500	5,105	10,942	16,348	14,661	10,041	9,151	7,269	5,000	4,000	3,000
80%	4,000	4,500	4,500	8,429	12,229	12,229	9,534	8,708	7,100	5,000	3,773	3,000
90%	3,438	3,500	4,500	6,588	10,088	9,776	8,880	7,114	6,340	4,000	3,502	3,000
Long Term												
Full Simulation Period ^b	4,645	8,510	22,907	42,197	55,831	43,614	27,068	18,884	11,853	7,445	4,102	3,983
Water Year Types^c												
Wet (32%)	5,533	13,286	48,963	88,678	103,568	82,641	50,579	35,425	20,319	9,843	4,400	5,361
Above Normal (16%)	4,112	9,509	22,621	46,272	67,829	53,845	27,145	16,693	9,448	9,777	4,053	3,770
Below Normal (13%)	4,735	7,275	8,857	14,292	36,552	17,538	13,660	11,701	8,957	7,113	4,145	3,456
Dry (24%)	4,234	4,975	7,135	13,254	22,732	20,102	14,775	10,322	7,628	5,038	3,937	3,209
Critical (15%)	3,904	4,104	5,928	10,890	12,243	11,062	8,824	6,276	5,809	4,038	3,749	3,000

Alternative 1 minus No Action Alternative												
Statistic	Monthly Outflow Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-4,189	44	-657	3,809	3,937	5,701	-3,533	-5,003	-227	-1,504	-151	-15,141
20%	-4,928	-8,251	-1,710	2,397	135	3,283	-4,273	-2,350	1,167	-1,539	-130	-15,026
30%	-5,079	-8,359	-847	-5,208	-4,350	-2,956	-5,057	-4,002	684	-941	0	-11,345
40%	-2,790	-6,145	-2,056	-3,722	637	-489	-4,845	-3,297	1,535	-85	0	-7,212
50%	-392	-5,344	-2,174	-3,565	-2,400	-889	-5,737	-1,771	1,283	-274	0	-702
60%	0	-1,683	372	-3,544	-3,950	-1,620	-3,732	-917	1,042	0	0	-342
70%	0	0	-12	-2,076	-2,063	-2,600	-2,694	-478	405	0	0	0
80%	0	0	-22	-1,095	-2,419	-503	-521	248	665	0	-227	0
90%	438	-37	0	-1,311	-932	-990	-599	-132	733	-2	-397	0
Long Term												
Full Simulation Period ^b	-1,872	-3,022	-120	-2,035	-1,085	-255	-3,380	-1,953	967	-605	-87	-5,518
Water Year Types^c												
Wet (32%)	-2,916	-3,855	1,590	-919	155	1,328	-4,679	-3,515	1,492	-815	-36	-13,683
Above Normal (16%)	-1,281	-2,961	-1,804	-3,321	235	1,210	-5,425	-2,832	1,298	-1,069	-31	-7,360
Below Normal (13%)	-2,929	-3,643	-603	-3,218	221	-557	-3,464	-1,126	1,484	-1,143	9	-94
Dry (24%)	-1,313	-2,926	-532	-2,698	-3,114	-2,597	-2,007	-742	385	-93	-245	1
Critical (15%)	-214	-876	-869	-871	-3,016	-1,094	-563	-395	-31	-7	-80	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-15-1-2. Sacramento/San Joaquin River Delta Outflow, Monthly Outflow Rate

No Action Alternative												
Statistic	Monthly Outflow Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	9,992	15,000	66,586	102,991	136,665	88,553	69,913	46,324	19,838	12,406	4,507	19,516
20%	9,531	14,688	34,349	70,303	88,107	67,957	47,628	28,079	10,238	11,185	4,216	19,063
30%	9,375	13,860	16,305	51,208	65,254	46,096	30,159	19,514	9,204	9,315	4,000	15,282
40%	6,875	11,037	12,381	29,158	51,473	34,027	25,272	16,321	7,814	8,085	4,000	11,031
50%	4,392	9,844	9,938	21,131	36,676	27,251	20,111	13,711	7,243	8,000	4,000	4,385
60%	4,000	6,183	5,835	17,085	24,952	19,582	15,896	11,883	7,100	6,500	4,000	3,376
70%	4,000	4,500	5,118	13,018	18,411	17,261	12,735	9,629	6,864	5,000	4,000	3,000
80%	4,000	4,500	4,522	9,524	14,648	12,732	10,054	8,460	6,435	5,000	4,000	3,000
90%	3,000	3,537	4,500	7,899	11,020	10,766	9,479	7,246	5,606	4,002	3,899	3,000
Long Term												
Full Simulation Period ^b	6,518	11,533	23,026	44,232	56,916	43,869	30,448	20,838	10,885	8,050	4,189	9,501
Water Year Types^c												
Wet (32%)	8,450	17,141	47,372	89,598	103,413	81,313	55,257	38,940	18,827	10,658	4,436	19,044
Above Normal (16%)	5,392	12,471	24,425	49,593	67,594	52,635	32,571	19,525	8,150	10,846	4,084	11,130
Below Normal (13%)	7,664	10,918	9,460	17,510	36,331	18,095	17,124	12,827	7,473	8,256	4,136	3,549
Dry (24%)	5,547	7,902	7,667	15,952	25,846	22,699	16,782	11,064	7,243	5,131	4,182	3,208
Critical (15%)	4,118	4,980	6,796	11,761	15,260	12,156	9,387	6,671	5,840	4,045	3,829	3,000

Alternative 3												
Statistic	Monthly Outflow Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,847	15,154	67,577	108,085	138,218	94,128	64,058	40,190	17,907	11,848	4,317	4,383
20%	4,327	6,536	34,797	72,564	85,533	69,817	43,431	22,486	10,580	10,710	4,000	4,124
30%	4,176	5,360	18,763	50,474	66,669	44,146	25,623	14,849	9,614	9,349	4,000	3,952
40%	4,000	4,875	11,747	30,502	54,582	34,751	20,811	12,202	8,431	8,000	4,000	3,846
50%	4,000	4,500	7,809	22,735	37,427	27,283	14,576	11,448	8,008	8,000	4,000	3,723
60%	4,000	4,500	6,476	17,252	25,450	19,269	12,680	10,242	7,327	6,964	4,000	3,203
70%	4,000	4,500	5,469	12,485	19,194	16,786	10,104	9,418	7,100	5,000	4,000	3,000
80%	4,000	4,500	4,503	9,746	14,731	12,839	9,507	8,024	6,875	5,000	3,920	3,000
90%	3,001	3,500	4,500	8,078	11,090	10,632	8,602	7,100	5,892	4,000	3,615	3,000
Long Term												
Full Simulation Period ^b	4,505	8,498	23,825	45,081	57,802	44,096	27,167	18,245	11,031	7,975	4,104	4,026
Water Year Types^c												
Wet (32%)	5,423	13,295	50,679	91,224	104,154	81,635	50,352	34,298	18,791	10,556	4,409	5,366
Above Normal (16%)	3,934	9,552	23,767	50,344	69,257	53,533	27,491	15,605	8,638	10,485	4,000	3,825
Below Normal (13%)	4,567	7,085	9,173	18,801	38,748	18,208	14,380	11,370	7,675	8,245	4,137	3,713
Dry (24%)	4,068	5,000	7,431	16,141	26,123	22,516	14,820	9,949	7,478	5,225	3,977	3,204
Critical (15%)	3,807	4,091	6,456	11,729	15,231	12,233	8,880	6,454	5,809	4,000	3,740	3,000

Alternative 3 minus No Action Alternative												
Statistic	Monthly Outflow Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-5,145	154	991	5,095	1,553	5,575	-5,855	-6,135	-1,931	-558	-189	-15,132
20%	-5,204	-8,152	449	2,261	-2,574	1,860	-4,197	-5,593	342	-475	-216	-14,938
30%	-5,199	-8,500	2,458	-734	1,415	-1,950	-4,536	-4,664	410	34	0	-11,330
40%	-2,875	-6,162	-634	1,344	3,109	723	-4,461	-4,119	617	-85	0	-7,186
50%	-392	-5,344	-2,129	1,604	751	32	-5,534	-2,263	765	0	0	-661
60%	0	-1,683	641	167	498	-313	-3,217	-1,641	227	464	0	-174
70%	0	0	352	-533	783	-475	-2,631	-211	236	0	0	0
80%	0	0	-19	222	84	107	-548	-436	440	0	-80	0
90%	1	-37	0	179	70	-134	-877	-146	286	-2	-283	0
Long Term												
Full Simulation Period ^b	-2,012	-3,034	798	849	886	226	-3,281	-2,593	145	-75	-85	-5,474
Water Year Types^c												
Wet (32%)	-3,026	-3,846	3,307	1,626	740	322	-4,905	-4,642	-37	-103	-27	-13,678
Above Normal (16%)	-1,458	-2,919	-658	751	1,663	898	-5,080	-3,921	487	-361	-84	-7,305
Below Normal (13%)	-3,097	-3,834	-287	1,291	2,418	113	-2,744	-1,458	202	-11	1	164
Dry (24%)	-1,479	-2,902	-236	189	277	-183	-1,961	-1,115	235	94	-205	-4
Critical (15%)	-311	-889	-340	-32	-29	78	-507	-217	-31	-44	-89	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-15-1-3. Sacramento/San Joaquin River Delta Outflow, Monthly Outflow Rate

No Action Alternative												
Statistic	Monthly Outflow Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	9,992	15,000	66,586	102,991	136,665	88,553	69,913	46,324	19,838	12,406	4,507	19,516
20%	9,531	14,688	34,349	70,303	88,107	67,957	47,628	28,079	10,238	11,185	4,216	19,063
30%	9,375	13,860	16,305	51,208	65,254	46,096	30,159	19,514	9,204	9,315	4,000	15,282
40%	6,875	11,037	12,381	29,158	51,473	34,027	25,272	16,321	7,814	8,085	4,000	11,031
50%	4,392	9,844	9,938	21,131	36,676	27,251	20,111	13,711	7,243	8,000	4,000	4,385
60%	4,000	6,183	5,835	17,085	24,952	19,582	15,896	11,883	7,100	6,500	4,000	3,376
70%	4,000	4,500	5,118	13,018	18,411	17,261	12,735	9,629	6,864	5,000	4,000	3,000
80%	4,000	4,500	4,522	9,524	14,648	12,732	10,054	8,460	6,435	5,000	4,000	3,000
90%	3,000	3,537	4,500	7,899	11,020	10,766	9,479	7,246	5,606	4,002	3,899	3,000
Long Term												
Full Simulation Period ^b	6,518	11,533	23,026	44,232	56,916	43,869	30,448	20,838	10,885	8,050	4,189	9,501
Water Year Types^c												
Wet (32%)	8,450	17,141	47,372	89,598	103,413	81,313	55,257	38,940	18,827	10,658	4,436	19,044
Above Normal (16%)	5,392	12,471	24,425	49,593	67,594	52,635	32,571	19,525	8,150	10,846	4,084	11,130
Below Normal (13%)	7,664	10,918	9,460	17,510	36,331	18,095	17,124	12,827	7,473	8,256	4,136	3,549
Dry (24%)	5,547	7,902	7,667	15,952	25,846	22,699	16,782	11,064	7,243	5,131	4,182	3,208
Critical (15%)	4,118	4,980	6,796	11,761	15,260	12,156	9,387	6,671	5,840	4,045	3,829	3,000

Alternative 5												
Statistic	Monthly Outflow Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	10,133	16,136	66,931	103,093	136,599	88,457	69,913	46,327	19,833	12,471	4,626	19,516
20%	9,656	14,688	34,352	70,235	86,928	67,878	47,175	28,669	10,186	11,191	4,165	19,063
30%	9,375	13,956	16,399	51,208	65,777	46,107	30,216	20,119	8,813	9,640	4,000	15,287
40%	6,875	11,099	12,398	29,024	51,418	34,026	25,913	16,298	7,617	8,150	4,000	10,938
50%	4,183	9,844	10,026	21,152	36,972	27,098	20,741	14,190	7,113	8,000	4,000	4,292
60%	4,000	6,200	5,833	17,051	24,932	19,564	17,274	12,619	7,100	6,500	4,000	3,425
70%	4,000	4,500	5,046	13,016	18,412	17,193	13,722	10,228	6,742	5,013	4,000	3,000
80%	4,000	4,500	4,650	9,518	14,601	12,730	11,957	9,116	6,225	5,000	4,000	3,000
90%	3,000	3,543	4,500	7,907	11,015	10,768	10,467	7,519	5,545	4,000	3,742	3,000
Long Term												
Full Simulation Period ^b	6,517	11,601	22,977	44,143	56,887	43,828	31,056	21,333	10,797	8,125	4,179	9,499
Water Year Types^c												
Wet (32%)	8,415	17,140	47,249	89,426	103,463	81,244	55,257	39,213	18,770	10,842	4,436	19,027
Above Normal (16%)	5,427	12,884	24,469	49,565	67,378	52,557	32,721	19,885	8,108	10,860	4,082	11,106
Below Normal (13%)	7,655	10,920	9,460	17,477	36,320	18,058	17,828	13,354	7,294	8,350	4,137	3,594
Dry (24%)	5,567	7,917	7,596	15,936	25,862	22,697	18,159	11,710	7,102	5,143	4,164	3,216
Critical (15%)	4,127	4,974	6,794	11,614	15,167	12,145	10,437	7,514	5,809	4,043	3,792	3,000

Alternative 5 minus No Action Alternative												
Statistic	Monthly Outflow Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	141	1,136	345	102	-66	-96	0	3	-5	65	119	0
20%	125	0	3	-68	-1,179	-79	-454	590	-52	6	-51	0
30%	0	97	94	0	523	11	57	605	-391	325	0	5
40%	0	62	17	-134	-55	-2	641	-23	-197	65	0	-94
50%	-209	0	88	21	296	-153	630	479	-131	0	0	-93
60%	0	17	-2	-34	-20	-18	1,378	737	0	0	0	48
70%	0	0	-72	-2	1	-68	987	598	-122	13	0	0
80%	0	0	128	-6	-46	-3	1,903	656	-210	0	0	0
90%	0	6	0	8	-5	2	988	273	-62	-2	-156	0
Long Term												
Full Simulation Period ^b	0	68	-50	-89	-29	-41	608	495	-88	76	-10	-1
Water Year Types^c												
Wet (32%)	-34	-1	-123	-172	50	-68	-1	273	-58	183	0	-18
Above Normal (16%)	35	413	44	-28	-216	-78	151	360	-43	14	-2	-24
Below Normal (13%)	-9	1	0	-33	-11	-37	703	526	-179	94	0	45
Dry (24%)	21	15	-71	-16	16	-2	1,377	646	-141	12	-18	8
Critical (15%)	9	-7	-2	-146	-93	-11	1,049	843	-31	-2	-38	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-15-1-4. Sacramento/San Joaquin River Delta Outflow, Monthly Outflow Rate

Second Basis of Comparison

Statistic	Monthly Outflow Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	5,803	15,044	65,929	106,799	140,602	94,253	66,380	41,321	19,611	10,902	4,356	4,374
20%	4,603	6,436	32,639	72,700	88,242	71,240	43,356	25,729	11,405	9,646	4,087	4,037
30%	4,296	5,501	15,458	45,999	60,904	43,140	25,102	15,512	9,888	8,374	4,000	3,937
40%	4,085	4,892	10,325	25,436	52,110	33,538	20,427	13,024	9,349	8,000	4,000	3,819
50%	4,000	4,500	7,764	17,566	34,276	26,362	14,374	11,939	8,527	7,726	4,000	3,682
60%	4,000	4,500	6,206	13,540	21,001	17,962	12,164	10,966	8,142	6,500	4,000	3,034
70%	4,000	4,500	5,105	10,942	16,348	14,661	10,041	9,151	7,269	5,000	4,000	3,000
80%	4,000	4,500	4,500	8,429	12,229	12,229	9,534	8,708	7,100	5,000	3,773	3,000
90%	3,438	3,500	4,500	6,588	10,088	9,776	8,880	7,114	6,340	4,000	3,502	3,000
Long Term												
Full Simulation Period ^b	4,645	8,510	22,907	42,197	55,831	43,614	27,068	18,884	11,853	7,445	4,102	3,983
Water Year Types^c												
Wet (32%)	5,533	13,286	48,963	88,678	103,568	82,641	50,579	35,425	20,319	9,843	4,400	5,361
Above Normal (16%)	4,112	9,509	22,621	46,272	67,829	53,845	27,145	16,693	9,448	9,777	4,053	3,770
Below Normal (13%)	4,735	7,275	8,857	14,292	36,552	17,538	13,660	11,701	8,957	7,113	4,145	3,456
Dry (24%)	4,234	4,975	7,135	13,254	22,732	20,102	14,775	10,322	7,628	5,038	3,937	3,209
Critical (15%)	3,904	4,104	5,928	10,890	12,243	11,062	8,824	6,276	5,809	4,038	3,749	3,000

No Action Alternative

Statistic	Monthly Outflow Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	9,992	15,000	66,586	102,991	136,665	88,553	69,913	46,324	19,838	12,406	4,507	19,516
20%	9,531	14,688	34,349	70,303	88,107	67,957	47,628	28,079	10,238	11,185	4,216	19,063
30%	9,375	13,860	16,305	51,208	65,254	46,096	30,159	19,514	9,204	9,315	4,000	15,282
40%	6,875	11,037	12,381	29,158	51,473	34,027	25,272	16,321	7,814	8,085	4,000	11,031
50%	4,392	9,844	9,938	21,131	36,676	27,251	20,111	13,711	7,243	8,000	4,000	4,385
60%	4,000	6,183	5,835	17,085	24,952	19,582	15,896	11,883	7,100	6,500	4,000	3,376
70%	4,000	4,500	5,118	13,018	18,411	17,261	12,735	9,629	6,864	5,000	4,000	3,000
80%	4,000	4,500	4,522	9,524	14,648	12,732	10,054	8,460	6,435	5,000	4,000	3,000
90%	3,000	3,537	4,500	7,899	11,020	10,766	9,479	7,246	5,606	4,002	3,899	3,000
Long Term												
Full Simulation Period ^b	6,518	11,533	23,026	44,232	56,916	43,869	30,448	20,838	10,885	8,050	4,189	9,501
Water Year Types^c												
Wet (32%)	8,450	17,141	47,372	89,598	103,413	81,313	55,257	38,940	18,827	10,658	4,436	19,044
Above Normal (16%)	5,392	12,471	24,425	49,593	67,594	52,635	32,571	19,525	8,150	10,846	4,084	11,130
Below Normal (13%)	7,664	10,918	9,460	17,510	36,331	18,095	17,124	12,827	7,473	8,256	4,136	3,549
Dry (24%)	5,547	7,902	7,667	15,952	25,846	22,699	16,782	11,064	7,243	5,131	4,182	3,208
Critical (15%)	4,118	4,980	6,796	11,761	15,260	12,156	9,387	6,671	5,840	4,045	3,829	3,000

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Outflow Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,189	-44	657	-3,809	-3,937	-5,701	3,533	5,003	227	1,504	151	15,141
20%	4,928	8,251	1,710	-2,397	-135	-3,283	4,273	2,350	-1,167	1,539	130	15,026
30%	5,079	8,359	847	5,208	4,350	2,956	5,057	4,002	-684	941	0	11,345
40%	2,790	6,145	2,056	3,722	-637	489	4,845	3,297	-1,535	85	0	7,212
50%	392	5,344	2,174	3,565	2,400	889	5,737	1,771	-1,283	274	0	702
60%	0	1,683	-372	3,544	3,950	1,620	3,732	917	-1,042	0	0	342
70%	0	0	12	2,076	2,063	2,600	2,694	478	-405	0	0	0
80%	0	0	22	1,095	2,419	503	521	-248	-665	0	227	0
90%	-438	37	0	1,311	932	990	599	132	-733	2	397	0
Long Term												
Full Simulation Period ^b	1,872	3,022	120	2,035	1,085	255	3,380	1,953	-967	605	87	5,518
Water Year Types^c												
Wet (32%)	2,916	3,855	-1,590	919	-155	-1,328	4,679	3,515	-1,492	815	36	13,683
Above Normal (16%)	1,281	2,961	1,804	3,321	-235	-1,210	5,425	2,832	-1,298	1,069	31	7,360
Below Normal (13%)	2,929	3,643	603	3,218	-221	557	3,464	1,126	-1,484	1,143	-9	94
Dry (24%)	1,313	2,926	532	2,698	3,114	2,597	2,007	742	-385	93	245	-1
Critical (15%)	214	876	869	871	3,016	1,094	563	395	31	7	80	0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-15-1-5. Sacramento/San Joaquin River Delta Outflow, Monthly Outflow Rate

Second Basis of Comparison												
Statistic	Monthly Outflow Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	5,803	15,044	65,929	106,799	140,602	94,253	66,380	41,321	19,611	10,902	4,356	4,374
20%	4,603	6,436	32,639	72,700	88,242	71,240	43,356	25,729	11,405	9,646	4,087	4,037
30%	4,296	5,501	15,458	45,999	60,904	43,140	25,102	15,512	9,888	8,374	4,000	3,937
40%	4,085	4,892	10,325	25,436	52,110	33,538	20,427	13,024	9,349	8,000	4,000	3,819
50%	4,000	4,500	7,764	17,566	34,276	26,362	14,374	11,939	8,527	7,726	4,000	3,682
60%	4,000	4,500	6,206	13,540	21,001	17,962	12,164	10,966	8,142	6,500	4,000	3,034
70%	4,000	4,500	5,105	10,942	16,348	14,661	10,041	9,151	7,269	5,000	4,000	3,000
80%	4,000	4,500	4,500	8,429	12,229	12,229	9,534	8,708	7,100	5,000	3,773	3,000
90%	3,438	3,500	4,500	6,588	10,088	9,776	8,880	7,114	6,340	4,000	3,502	3,000
Long Term												
Full Simulation Period ^b	4,645	8,510	22,907	42,197	55,831	43,614	27,068	18,884	11,853	7,445	4,102	3,983
Water Year Types^c												
Wet (32%)	5,533	13,286	48,963	88,678	103,568	82,641	50,579	35,425	20,319	9,843	4,400	5,361
Above Normal (16%)	4,112	9,509	22,621	46,272	67,829	53,845	27,145	16,693	9,448	9,777	4,053	3,770
Below Normal (13%)	4,735	7,275	8,857	14,292	36,552	17,538	13,660	11,701	8,957	7,113	4,145	3,456
Dry (24%)	4,234	4,975	7,135	13,254	22,732	20,102	14,775	10,322	7,628	5,038	3,937	3,209
Critical (15%)	3,904	4,104	5,928	10,890	12,243	11,062	8,824	6,276	5,809	4,038	3,749	3,000

Alternative 3												
Statistic	Monthly Outflow Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,847	15,154	67,577	108,085	138,218	94,128	64,058	40,190	17,907	11,848	4,317	4,383
20%	4,327	6,536	34,797	72,564	85,533	69,817	43,431	22,486	10,580	10,710	4,000	4,124
30%	4,176	5,360	18,763	50,474	66,669	44,146	25,623	14,849	9,614	9,349	4,000	3,952
40%	4,000	4,875	11,747	30,502	54,582	34,751	20,811	12,202	8,431	8,000	4,000	3,846
50%	4,000	4,500	7,809	22,735	37,427	27,283	14,576	11,448	8,008	8,000	4,000	3,723
60%	4,000	4,500	6,476	17,252	25,450	19,269	12,680	10,242	7,327	6,964	4,000	3,203
70%	4,000	4,500	5,469	12,485	19,194	16,786	10,104	9,418	7,100	5,000	4,000	3,000
80%	4,000	4,500	4,503	9,746	14,731	12,839	9,507	8,024	6,875	5,000	3,920	3,000
90%	3,001	3,500	4,500	8,078	11,090	10,632	8,602	7,100	5,892	4,000	3,615	3,000
Long Term												
Full Simulation Period ^b	4,505	8,498	23,825	45,081	57,802	44,096	27,167	18,245	11,031	7,975	4,104	4,026
Water Year Types^c												
Wet (32%)	5,423	13,295	50,679	91,224	104,154	81,635	50,352	34,298	18,791	10,556	4,409	5,366
Above Normal (16%)	3,934	9,552	23,767	50,344	69,257	53,533	27,491	15,605	8,638	10,485	4,000	3,825
Below Normal (13%)	4,567	7,085	9,173	18,801	38,748	18,208	14,380	11,370	7,675	8,245	4,137	3,713
Dry (24%)	4,068	5,000	7,431	16,141	26,123	22,516	14,820	9,949	7,478	5,225	3,977	3,204
Critical (15%)	3,807	4,091	6,456	11,729	15,231	12,233	8,880	6,454	5,809	4,000	3,740	3,000

Alternative 3 minus Second Basis of Comparison												
Statistic	Monthly Outflow Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-956	110	1,648	1,286	-2,383	-126	-2,322	-1,131	-1,704	946	-39	9
20%	-276	99	2,158	-136	-2,709	-1,423	75	-3,243	-824	1,064	-86	88
30%	-121	-141	3,305	4,475	5,765	1,006	521	-663	-274	975	0	15
40%	-85	-17	1,422	5,066	2,471	1,212	384	-822	-918	0	0	27
50%	0	0	45	5,169	3,152	921	203	-491	-519	274	0	41
60%	0	0	269	3,712	4,449	1,308	515	-724	-815	464	0	169
70%	0	0	364	1,543	2,846	2,125	63	267	-169	0	0	0
80%	0	0	3	1,317	2,503	610	-27	-684	-225	0	148	0
90%	-436	0	0	1,489	1,002	856	-278	-14	-448	0	113	0
Long Term												
Full Simulation Period ^b	-140	-12	918	2,885	1,971	482	99	-639	-822	530	2	44
Water Year Types^c												
Wet (32%)	-110	9	1,717	2,546	586	-1,006	-226	-1,127	-1,529	713	9	5
Above Normal (16%)	-178	42	1,146	4,072	1,427	-311	345	-1,088	-810	709	-53	55
Below Normal (13%)	-167	-191	316	4,509	2,197	670	720	-331	-1,282	1,132	-8	257
Dry (24%)	-166	24	296	2,887	3,391	2,414	46	-373	-150	187	40	-5
Critical (15%)	-97	-13	529	838	2,987	1,172	56	178	0	-37	-9	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-15-1-6. Sacramento/San Joaquin River Delta Outflow, Monthly Outflow Rate

Second Basis of Comparison

Statistic	Monthly Outflow Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	5,803	15,044	65,929	106,799	140,602	94,253	66,380	41,321	19,611	10,902	4,356	4,374
20%	4,603	6,436	32,639	72,700	88,242	71,240	43,356	25,729	11,405	9,646	4,087	4,037
30%	4,296	5,501	15,458	45,999	60,904	43,140	25,102	15,512	9,888	8,374	4,000	3,937
40%	4,085	4,892	10,325	25,436	52,110	33,538	20,427	13,024	9,349	8,000	4,000	3,819
50%	4,000	4,500	7,764	17,566	34,276	26,362	14,374	11,939	8,527	7,726	4,000	3,682
60%	4,000	4,500	6,206	13,540	21,001	17,962	12,164	10,966	8,142	6,500	4,000	3,034
70%	4,000	4,500	5,105	10,942	16,348	14,661	10,041	9,151	7,269	5,000	4,000	3,000
80%	4,000	4,500	4,500	8,429	12,229	12,229	9,534	8,708	7,100	5,000	3,773	3,000
90%	3,438	3,500	4,500	6,588	10,088	9,776	8,880	7,114	6,340	4,000	3,502	3,000
Long Term												
Full Simulation Period ^b	4,645	8,510	22,907	42,197	55,831	43,614	27,068	18,884	11,853	7,445	4,102	3,983
Water Year Types^c												
Wet (32%)	5,533	13,286	48,963	88,678	103,568	82,641	50,579	35,425	20,319	9,843	4,400	5,361
Above Normal (16%)	4,112	9,509	22,621	46,272	67,829	53,845	27,145	16,693	9,448	9,777	4,053	3,770
Below Normal (13%)	4,735	7,275	8,857	14,292	36,552	17,538	13,660	11,701	8,957	7,113	4,145	3,456
Dry (24%)	4,234	4,975	7,135	13,254	22,732	20,102	14,775	10,322	7,628	5,038	3,937	3,209
Critical (15%)	3,904	4,104	5,928	10,890	12,243	11,062	8,824	6,276	5,809	4,038	3,749	3,000

Alternative 5

Statistic	Monthly Outflow Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	10,133	16,136	66,931	103,093	136,599	88,457	69,913	46,327	19,833	12,471	4,626	19,516
20%	9,656	14,688	34,352	70,235	86,928	67,878	47,175	28,669	10,186	11,191	4,165	19,063
30%	9,375	13,956	16,399	51,208	65,777	46,107	30,216	20,119	8,813	9,640	4,000	15,287
40%	6,875	11,099	12,398	29,024	51,418	34,026	25,913	16,298	7,617	8,150	4,000	10,938
50%	4,183	9,844	10,026	21,152	36,972	27,098	20,741	14,190	7,113	8,000	4,000	4,292
60%	4,000	6,200	5,833	17,051	24,932	19,564	17,274	12,619	7,100	6,500	4,000	3,425
70%	4,000	4,500	5,046	13,016	18,412	17,193	13,722	10,228	6,742	5,013	4,000	3,000
80%	4,000	4,500	4,650	9,518	14,601	12,730	11,957	9,116	6,225	5,000	4,000	3,000
90%	3,000	3,543	4,500	7,907	11,015	10,768	10,467	7,519	5,545	4,000	3,742	3,000
Long Term												
Full Simulation Period ^b	6,517	11,601	22,977	44,143	56,887	43,828	31,056	21,333	10,797	8,125	4,179	9,499
Water Year Types^c												
Wet (32%)	8,415	17,140	47,249	89,426	103,463	81,244	55,257	39,213	18,770	10,842	4,436	19,027
Above Normal (16%)	5,427	12,884	24,469	49,565	67,378	52,557	32,721	19,885	8,108	10,860	4,082	11,106
Below Normal (13%)	7,655	10,920	9,460	17,477	36,320	18,058	17,828	13,354	7,294	8,350	4,137	3,594
Dry (24%)	5,567	7,917	7,596	15,936	25,862	22,697	18,159	11,710	7,102	5,143	4,164	3,216
Critical (15%)	4,127	4,974	6,794	11,614	15,167	12,145	10,437	7,514	5,809	4,043	3,792	3,000

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Outflow Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,330	1,092	1,002	-3,706	-4,003	-5,796	3,533	5,006	222	1,569	270	15,141
20%	5,053	8,251	1,713	-2,465	-1,314	-3,362	3,819	2,940	-1,219	1,545	79	15,026
30%	5,079	8,456	941	5,209	4,873	2,967	5,114	4,607	-1,075	1,266	0	11,350
40%	2,790	6,207	2,073	3,588	-692	487	5,487	3,274	-1,732	150	0	7,119
50%	183	5,344	2,262	3,586	2,696	736	6,367	2,251	-1,414	274	0	610
60%	0	1,700	-374	3,511	3,931	1,603	5,110	1,654	-1,042	0	0	391
70%	0	0	-59	2,074	2,064	2,532	3,681	1,076	-526	13	0	0
80%	0	0	150	1,089	2,373	501	2,424	407	-875	0	227	0
90%	-438	43	0	1,319	928	992	1,587	405	-795	0	240	0
Long Term												
Full Simulation Period ^b	1,872	3,091	70	1,946	1,056	214	3,988	2,449	-1,055	681	77	5,516
Water Year Types^c												
Wet (32%)	2,882	3,854	-1,713	748	-105	-1,396	4,678	3,788	-1,550	999	36	13,666
Above Normal (16%)	1,316	3,374	1,848	3,293	-452	-1,288	5,576	3,192	-1,340	1,084	29	7,336
Below Normal (13%)	2,920	3,644	603	3,185	-231	520	4,168	1,652	-1,663	1,237	-8	139
Dry (24%)	1,333	2,941	460	2,682	3,130	2,595	3,384	1,388	-526	105	227	7
Critical (15%)	223	870	867	724	2,924	1,083	1,613	1,238	0	5	43	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-15-2-1. Sacramento/San Joaquin River Delta Outflow, Monthly Outflow Volume

No Action Alternative												
Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	614	893	4,094	6,333	7,834	5,445	4,160	2,848	1,180	763	277	1,161
20%	586	874	2,112	4,323	4,927	4,179	2,834	1,727	609	688	259	1,134
30%	576	825	1,003	3,149	3,624	2,834	1,795	1,200	548	573	246	909
40%	423	657	761	1,793	2,868	2,092	1,504	1,004	465	497	246	656
50%	270	586	611	1,299	2,037	1,676	1,197	843	431	492	246	261
60%	246	368	359	1,050	1,407	1,204	946	731	422	400	246	201
70%	246	268	315	800	1,023	1,061	758	592	408	307	246	179
80%	246	268	278	586	823	783	598	520	383	307	246	179
90%	184	210	277	486	633	662	564	446	334	246	240	179
Long Term												
Full Simulation Period ^b	401	686	1,416	2,720	3,186	2,697	1,812	1,281	648	495	258	565
Water Year Types^c												
Wet (32%)	520	1,020	2,913	5,509	5,771	5,000	3,288	2,394	1,120	655	273	1,133
Above Normal (16%)	332	742	1,502	3,049	3,807	3,236	1,938	1,201	485	667	251	662
Below Normal (13%)	471	650	582	1,077	2,048	1,113	1,019	789	445	508	254	211
Dry (24%)	341	470	471	981	1,443	1,396	999	680	431	315	257	191
Critical (15%)	253	296	418	723	861	747	559	410	348	249	235	179

Alternative 1												
Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	357	895	4,054	6,567	8,061	5,795	3,950	2,541	1,167	670	268	260
20%	283	383	2,007	4,470	4,927	4,380	2,580	1,582	679	593	251	240
30%	264	327	950	2,828	3,382	2,653	1,494	954	588	515	246	234
40%	251	291	635	1,564	2,894	2,062	1,215	801	556	492	246	227
50%	246	268	477	1,080	1,904	1,621	855	734	507	475	246	219
60%	246	268	382	833	1,179	1,104	724	674	485	400	246	181
70%	246	268	314	673	908	901	597	563	433	307	246	179
80%	246	268	277	518	698	752	567	535	422	307	232	179
90%	211	208	277	405	562	601	528	437	377	246	215	179
Long Term												
Full Simulation Period ^b	286	506	1,408	2,595	3,126	2,682	1,611	1,161	705	458	252	237
Water Year Types^c												
Wet (32%)	340	791	3,011	5,453	5,779	5,081	3,010	2,178	1,209	605	271	319
Above Normal (16%)	253	566	1,391	2,845	3,822	3,311	1,615	1,026	562	601	249	224
Below Normal (13%)	291	433	545	879	2,062	1,078	813	719	533	437	255	206
Dry (24%)	260	296	439	815	1,269	1,236	879	635	454	310	242	191
Critical (15%)	240	244	364	670	690	680	525	386	346	248	231	179

Alternative 1 minus No Action Alternative												
Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-258	3	-40	234	226	351	-210	-308	-14	-93	-9	-901
20%	-303	-491	-105	147	0	202	-254	-145	69	-95	-8	-894
30%	-312	-497	-52	-320	-242	-182	-301	-246	41	-58	0	-675
40%	-172	-366	-126	-229	26	-30	-288	-203	91	-5	0	-429
50%	-24	-318	-134	-219	-133	-55	-341	-109	76	-17	0	-42
60%	0	-100	23	-218	-228	-100	-222	-56	62	0	0	-20
70%	0	0	-1	-128	-115	-160	-160	-29	24	0	0	0
80%	0	0	-1	-67	-125	-31	-31	15	40	0	-14	0
90%	27	-2	0	-81	-71	-61	-36	-8	44	0	-24	0
Long Term												
Full Simulation Period ^b	-115	-180	-7	-125	-60	-16	-201	-120	58	-37	-5	-328
Water Year Types^c												
Wet (32%)	-179	-229	98	-57	9	82	-278	-216	89	-50	-2	-814
Above Normal (16%)	-79	-176	-111	-204	15	74	-323	-174	77	-66	-2	-438
Below Normal (13%)	-180	-217	-37	-198	15	-34	-206	-69	88	-70	1	-6
Dry (24%)	-81	-174	-33	-166	-174	-160	-119	-46	23	-6	-15	0
Critical (15%)	-13	-52	-53	-54	-171	-67	-34	-24	-2	0	-5	0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
^b Based on the 82-year simulation period.
^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-15-2.2. Sacramento/San Joaquin River Delta Outflow, Monthly Outflow Volume

No Action Alternative												
Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	614	893	4,094	6,333	7,834	5,445	4,160	2,848	1,180	763	277	1,161
20%	586	874	2,112	4,323	4,927	4,179	2,834	1,727	609	688	259	1,134
30%	576	825	1,003	3,149	3,624	2,834	1,795	1,200	548	573	246	909
40%	423	657	761	1,793	2,868	2,092	1,504	1,004	465	497	246	656
50%	270	586	611	1,299	2,037	1,676	1,197	843	431	492	246	261
60%	246	368	359	1,050	1,407	1,204	946	731	422	400	246	201
70%	246	268	315	800	1,023	1,061	758	592	408	307	246	179
80%	246	268	278	586	823	783	598	520	383	307	246	179
90%	184	210	277	486	633	662	564	446	334	246	240	179
Long Term												
Full Simulation Period ^b	401	686	1,416	2,720	3,186	2,697	1,812	1,281	648	495	258	565
Water Year Types^c												
Wet (32%)	520	1,020	2,913	5,509	5,771	5,000	3,288	2,394	1,120	655	273	1,133
Above Normal (16%)	332	742	1,502	3,049	3,807	3,236	1,938	1,201	485	667	251	662
Below Normal (13%)	471	650	582	1,077	2,048	1,113	1,019	789	445	508	254	211
Dry (24%)	341	470	471	981	1,443	1,396	999	680	431	315	257	191
Critical (15%)	253	296	418	723	861	747	559	410	348	249	235	179

Alternative 3												
Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	298	902	4,155	6,646	7,924	5,788	3,812	2,471	1,066	729	265	261
20%	266	389	2,140	4,462	4,802	4,293	2,584	1,383	630	659	246	245
30%	257	319	1,154	3,104	3,795	2,714	1,525	913	572	575	246	235
40%	246	290	722	1,875	3,031	2,137	1,238	750	502	492	246	229
50%	246	268	480	1,398	2,079	1,678	867	704	477	492	246	222
60%	246	268	398	1,061	1,416	1,185	754	630	436	428	246	191
70%	246	268	336	768	1,078	1,032	601	579	422	307	246	179
80%	246	268	277	599	821	789	566	493	409	307	241	179
90%	185	208	277	497	634	654	512	437	351	246	222	179
Long Term												
Full Simulation Period ^b	277	506	1,465	2,772	3,236	2,711	1,617	1,122	656	490	252	240
Water Year Types^c												
Wet (32%)	333	791	3,116	5,609	5,812	5,020	2,996	2,109	1,118	649	271	319
Above Normal (16%)	242	568	1,461	3,096	3,903	3,292	1,636	960	514	645	246	228
Below Normal (13%)	281	422	564	1,156	2,186	1,120	856	699	457	507	254	221
Dry (24%)	250	297	457	992	1,459	1,384	882	612	445	321	245	191
Critical (15%)	234	243	397	721	859	752	528	397	346	246	230	179

Alternative 3 minus No Action Alternative												
Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-316	9	61	313	89	343	-348	-377	-115	-34	-12	-900
20%	-320	-485	28	139	-125	114	-250	-344	20	-29	-13	-889
30%	-320	-506	151	-45	171	-120	-270	-287	24	2	0	-674
40%	-177	-367	-39	83	163	44	-265	-253	37	-5	0	-428
50%	-24	-318	-131	99	42	2	-329	-139	46	0	0	-39
60%	0	-100	39	10	8	-19	-191	-101	14	29	0	-10
70%	0	0	22	-33	56	-29	-157	-13	14	0	0	0
80%	0	0	-1	14	-3	7	-33	-27	26	0	-5	0
90%	0	-2	0	11	1	-8	-52	-9	17	0	-17	0
Long Term												
Full Simulation Period ^b	-124	-181	49	52	50	14	-195	-159	9	-5	-5	-326
Water Year Types^c												
Wet (32%)	-186	-229	203	100	41	20	-292	-285	-2	-6	-2	-814
Above Normal (16%)	-90	-174	-40	46	96	55	-302	-241	29	-22	-5	-435
Below Normal (13%)	-190	-228	-18	79	138	7	-163	-90	12	-1	0	10
Dry (24%)	-91	-173	-15	12	15	-11	-117	-69	14	6	-13	0
Critical (15%)	-19	-53	-21	-2	-2	5	-30	-13	-2	-3	-5	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-15-2.3. Sacramento/San Joaquin River Delta Outflow, Monthly Outflow Volume

No Action Alternative												
Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	614	893	4,094	6,333	7,834	5,445	4,160	2,848	1,180	763	277	1,161
20%	586	874	2,112	4,323	4,927	4,179	2,834	1,727	609	688	259	1,134
30%	576	825	1,003	3,149	3,624	2,834	1,795	1,200	548	573	246	909
40%	423	657	761	1,793	2,868	2,092	1,504	1,004	465	497	246	656
50%	270	586	611	1,299	2,037	1,676	1,197	843	431	492	246	261
60%	246	368	359	1,050	1,407	1,204	946	731	422	400	246	201
70%	246	268	315	800	1,023	1,061	758	592	408	307	246	179
80%	246	268	278	586	823	783	598	520	383	307	246	179
90%	184	210	277	486	633	662	564	446	334	246	240	179
Long Term												
Full Simulation Period ^b	401	686	1,416	2,720	3,186	2,697	1,812	1,281	648	495	258	565
Water Year Types ^c												
Wet (32%)	520	1,020	2,913	5,509	5,771	5,000	3,288	2,394	1,120	655	273	1,133
Above Normal (16%)	332	742	1,502	3,049	3,807	3,236	1,938	1,201	485	667	251	662
Below Normal (13%)	471	650	582	1,077	2,048	1,113	1,019	789	445	508	254	211
Dry (24%)	341	470	471	981	1,443	1,396	999	680	431	315	257	191
Critical (15%)	253	296	418	723	861	747	559	410	348	249	235	179

Alternative 5												
Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	623	960	4,115	6,339	7,831	5,439	4,160	2,849	1,180	767	284	1,161
20%	594	874	2,112	4,319	4,907	4,174	2,807	1,763	606	688	256	1,134
30%	576	830	1,008	3,149	3,653	2,835	1,798	1,237	524	593	246	910
40%	423	660	762	1,785	2,869	2,092	1,542	1,002	453	501	246	651
50%	257	586	616	1,301	2,053	1,666	1,234	873	423	492	246	255
60%	246	369	359	1,048	1,406	1,203	1,028	776	422	400	246	204
70%	246	268	310	800	1,025	1,057	817	629	401	308	246	179
80%	246	268	286	585	823	783	712	561	370	307	246	179
90%	184	211	277	486	633	662	623	462	330	246	230	179
Long Term												
Full Simulation Period ^b	401	690	1,413	2,714	3,184	2,695	1,848	1,312	642	500	257	565
Water Year Types ^c												
Wet (32%)	517	1,020	2,905	5,499	5,773	4,996	3,288	2,411	1,117	667	273	1,132
Above Normal (16%)	334	767	1,505	3,048	3,795	3,232	1,947	1,223	482	668	251	661
Below Normal (13%)	471	650	582	1,075	2,047	1,110	1,061	821	434	513	254	214
Dry (24%)	342	471	467	980	1,444	1,396	1,081	720	423	316	256	191
Critical (15%)	254	296	418	714	856	747	621	462	346	249	233	179

Alternative 5 minus No Action Alternative												
Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	9	68	21	6	-4	-6	0	0	0	4	7	0
20%	8	0	0	-4	-20	-5	-27	36	-3	0	-3	0
30%	0	6	6	0	29	1	3	37	-23	20	0	0
40%	0	4	1	-8	0	0	38	-1	-12	4	0	-6
50%	-13	0	5	1	16	-9	37	29	-8	0	0	-6
60%	0	1	0	-2	-2	-1	82	45	0	0	0	3
70%	0	0	-4	0	2	-4	59	37	-7	1	0	0
80%	0	0	8	0	0	0	113	40	-12	0	0	0
90%	0	0	0	0	0	0	59	17	-4	0	-10	0
Long Term												
Full Simulation Period ^b	0	4	-3	-5	-2	-3	36	30	-5	5	-1	0
Water Year Types ^c												
Wet (32%)	-2	0	-8	-11	3	-4	0	17	-3	11	0	-1
Above Normal (16%)	2	25	3	-2	-12	-5	9	22	-3	1	0	-1
Below Normal (13%)	-1	0	0	-2	-1	-2	42	32	-11	6	0	3
Dry (24%)	1	1	-4	-1	1	0	82	40	-8	1	-1	0
Critical (15%)	1	0	0	-9	-5	-1	62	52	-2	0	-2	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-15-2-4. Sacramento/San Joaquin River Delta Outflow, Monthly Outflow Volume

Second Basis of Comparison												
Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	357	895	4,054	6,567	8,061	5,795	3,950	2,541	1,167	670	268	260
20%	283	383	2,007	4,470	4,927	4,380	2,580	1,582	679	593	251	240
30%	264	327	950	2,828	3,382	2,653	1,494	954	588	515	246	234
40%	251	291	635	1,564	2,894	2,062	1,215	801	556	492	246	227
50%	246	268	477	1,080	1,904	1,621	855	734	507	475	246	219
60%	246	268	382	833	1,179	1,104	724	674	485	400	246	181
70%	246	268	314	673	908	901	597	563	433	307	246	179
80%	246	268	277	518	698	752	567	535	422	307	232	179
90%	211	208	277	405	562	601	528	437	377	246	215	179
Long Term												
Full Simulation Period ^b	286	506	1,408	2,595	3,126	2,682	1,611	1,161	705	458	252	237
Water Year Types^c												
Wet (32%)	340	791	3,011	5,453	5,779	5,081	3,010	2,178	1,209	605	271	319
Above Normal (16%)	253	566	1,391	2,845	3,822	3,311	1,615	1,026	562	601	249	224
Below Normal (13%)	291	433	545	879	2,062	1,078	813	719	533	437	255	206
Dry (24%)	260	296	439	815	1,269	1,236	879	635	454	310	242	191
Critical (15%)	240	244	364	670	690	680	525	386	346	248	231	179

No Action Alternative												
Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	614	893	4,094	6,333	7,834	5,445	4,160	2,848	1,180	763	277	1,161
20%	586	874	2,112	4,323	4,927	4,179	2,834	1,727	609	688	259	1,134
30%	576	825	1,003	3,149	3,624	2,834	1,795	1,200	548	573	246	909
40%	423	657	761	1,793	2,868	2,092	1,504	1,004	465	497	246	656
50%	270	586	611	1,299	2,037	1,676	1,197	843	431	492	246	261
60%	246	368	359	1,050	1,407	1,204	946	731	422	400	246	201
70%	246	268	315	800	1,023	1,061	758	592	408	307	246	179
80%	246	268	278	586	823	783	598	520	383	307	246	179
90%	184	210	277	486	633	662	564	446	334	246	240	179
Long Term												
Full Simulation Period ^b	401	686	1,416	2,720	3,186	2,697	1,812	1,281	648	495	258	565
Water Year Types^c												
Wet (32%)	520	1,020	2,913	5,509	5,771	5,000	3,288	2,394	1,120	655	273	1,133
Above Normal (16%)	332	742	1,502	3,049	3,807	3,236	1,938	1,201	485	667	251	662
Below Normal (13%)	471	650	582	1,077	2,048	1,113	1,019	789	445	508	254	211
Dry (24%)	341	470	471	981	1,443	1,396	999	680	431	315	257	191
Critical (15%)	253	296	418	723	861	747	559	410	348	249	235	179

No Action Alternative minus Second Basis of Comparison												
Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	258	-3	40	-234	-226	-351	210	308	14	93	9	901
20%	303	491	105	-147	0	-202	254	145	-69	95	8	894
30%	312	497	52	320	242	182	301	246	-41	58	0	675
40%	172	366	126	229	-26	30	288	203	-91	5	0	429
50%	24	318	134	219	133	55	341	109	-76	17	0	42
60%	0	100	-23	218	228	100	222	56	-62	0	0	20
70%	0	0	1	128	115	160	160	29	-24	0	0	0
80%	0	0	1	67	125	31	31	-15	-40	0	14	0
90%	-27	2	0	81	71	61	36	8	-44	0	24	0
Long Term												
Full Simulation Period ^b	115	180	7	125	60	16	201	120	-58	37	5	328
Water Year Types^c												
Wet (32%)	179	229	-98	57	-9	-82	278	216	-89	50	2	814
Above Normal (16%)	79	176	111	204	-15	-74	323	174	-77	66	2	438
Below Normal (13%)	180	217	37	198	-15	34	206	69	-88	70	-1	6
Dry (24%)	81	174	33	166	174	160	119	46	-23	6	15	0
Critical (15%)	13	52	53	54	171	67	34	24	2	0	5	0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-15-2-5. Sacramento/San Joaquin River Delta Outflow, Monthly Outflow Volume

Second Basis of Comparison												
Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	357	895	4,054	6,567	8,061	5,795	3,950	2,541	1,167	670	268	260
20%	283	383	2,007	4,470	4,927	4,380	2,580	1,582	679	593	251	240
30%	264	327	950	2,828	3,382	2,653	1,494	954	588	515	246	234
40%	251	291	635	1,564	2,894	2,062	1,215	801	556	492	246	227
50%	246	268	477	1,080	1,904	1,621	855	734	507	475	246	219
60%	246	268	382	833	1,179	1,104	724	674	485	400	246	181
70%	246	268	314	673	908	901	597	563	433	307	246	179
80%	246	268	277	518	698	752	567	535	422	307	232	179
90%	211	208	277	405	562	601	528	437	377	246	215	179
Long Term												
Full Simulation Period ^b	286	506	1,408	2,595	3,126	2,682	1,611	1,161	705	458	252	237
Water Year Types^c												
Wet (32%)	340	791	3,011	5,453	5,779	5,081	3,010	2,178	1,209	605	271	319
Above Normal (16%)	253	566	1,391	2,845	3,822	3,311	1,615	1,026	562	601	249	224
Below Normal (13%)	291	433	545	879	2,062	1,078	813	719	533	437	255	206
Dry (24%)	260	296	439	815	1,269	1,236	879	635	454	310	242	191
Critical (15%)	240	244	364	670	690	680	525	386	346	248	231	179

Alternative 3												
Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	298	902	4,155	6,646	7,924	5,788	3,812	2,471	1,066	729	265	261
20%	266	389	2,140	4,462	4,802	4,293	2,584	1,383	630	659	246	245
30%	257	319	1,154	3,104	3,795	2,714	1,525	913	572	575	246	235
40%	246	290	722	1,875	3,031	2,137	1,238	750	502	492	246	229
50%	246	268	480	1,398	2,079	1,678	867	704	477	492	246	222
60%	246	268	398	1,061	1,416	1,185	754	630	436	428	246	191
70%	246	268	336	768	1,078	1,032	601	579	422	307	246	179
80%	246	268	277	599	821	789	566	493	409	307	241	179
90%	185	208	277	497	634	654	512	437	351	246	222	179
Long Term												
Full Simulation Period ^b	277	506	1,465	2,772	3,236	2,711	1,617	1,122	656	490	252	240
Water Year Types^c												
Wet (32%)	333	791	3,116	5,609	5,812	5,020	2,996	2,109	1,118	649	271	319
Above Normal (16%)	242	568	1,461	3,096	3,903	3,292	1,636	960	514	645	246	228
Below Normal (13%)	281	422	564	1,156	2,186	1,120	856	699	457	507	254	221
Dry (24%)	250	297	457	992	1,459	1,384	882	612	445	321	245	191
Critical (15%)	234	243	397	721	859	752	528	397	346	246	230	179

Alternative 3 minus Second Basis of Comparison												
Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-59	7	101	79	-137	-8	-138	-70	-101	58	-2	1
20%	-17	6	133	-8	-125	-88	4	-199	-49	65	-5	5
30%	-7	-8	203	275	413	62	31	-41	-16	60	0	1
40%	-5	-1	87	311	137	75	23	-51	-55	0	0	2
50%	0	0	3	318	175	57	12	-30	-31	17	0	2
60%	0	0	17	228	236	80	31	-44	-48	29	0	10
70%	0	0	22	95	171	131	4	16	-10	0	0	0
80%	0	0	0	81	122	37	-2	-42	-13	0	9	0
90%	-27	0	0	92	72	53	-17	-1	-27	0	7	0
Long Term												
Full Simulation Period ^b	-9	-1	56	177	111	30	6	-39	-49	33	0	3
Water Year Types^c												
Wet (32%)	-7	1	106	157	32	-62	-13	-69	-91	44	1	0
Above Normal (16%)	-11	3	70	250	81	-19	21	-67	-48	44	-3	3
Below Normal (13%)	-10	-11	19	277	123	41	43	-20	-76	70	0	15
Dry (24%)	-10	1	18	178	190	148	3	-23	-9	11	2	0
Critical (15%)	-6	-1	33	52	169	72	3	11	0	-2	-1	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-15-2-6. Sacramento/San Joaquin River Delta Outflow, Monthly Outflow Volume

Second Basis of Comparison

Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	357	895	4,054	6,567	8,061	5,795	3,950	2,541	1,167	670	268	260
20%	283	383	2,007	4,470	4,927	4,380	2,580	1,582	679	593	251	240
30%	264	327	950	2,828	3,382	2,653	1,494	954	588	515	246	234
40%	251	291	635	1,564	2,894	2,062	1,215	801	556	492	246	227
50%	246	268	477	1,080	1,904	1,621	855	734	507	475	246	219
60%	246	268	382	833	1,179	1,104	724	674	485	400	246	181
70%	246	268	314	673	908	901	597	563	433	307	246	179
80%	246	268	277	518	698	752	567	535	422	307	232	179
90%	211	208	277	405	562	601	528	437	377	246	215	179
Long Term												
Full Simulation Period ^b	286	506	1,408	2,595	3,126	2,682	1,611	1,161	705	458	252	237
Water Year Types^c												
Wet (32%)	340	791	3,011	5,453	5,779	5,081	3,010	2,178	1,209	605	271	319
Above Normal (16%)	253	566	1,391	2,845	3,822	3,311	1,615	1,026	562	601	249	224
Below Normal (13%)	291	433	545	879	2,062	1,078	813	719	533	437	255	206
Dry (24%)	260	296	439	815	1,269	1,236	879	635	454	310	242	191
Critical (15%)	240	244	364	670	690	680	525	386	346	248	231	179

Alternative 5

Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	623	960	4,115	6,339	7,831	5,439	4,160	2,849	1,180	767	284	1,161
20%	594	874	2,112	4,319	4,907	4,174	2,807	1,763	606	688	256	1,134
30%	576	830	1,008	3,149	3,653	2,835	1,798	1,237	524	593	246	910
40%	423	660	762	1,785	2,869	2,092	1,542	1,002	453	501	246	651
50%	257	586	616	1,301	2,053	1,666	1,234	873	423	492	246	255
60%	246	369	359	1,048	1,406	1,203	1,028	776	422	400	246	204
70%	246	268	310	800	1,025	1,057	817	629	401	308	246	179
80%	246	268	286	585	823	783	712	561	370	307	246	179
90%	184	211	277	486	633	662	623	462	330	246	230	179
Long Term												
Full Simulation Period ^b	401	690	1,413	2,714	3,184	2,695	1,848	1,312	642	500	257	565
Water Year Types^c												
Wet (32%)	517	1,020	2,905	5,499	5,773	4,996	3,288	2,411	1,117	667	273	1,132
Above Normal (16%)	334	767	1,505	3,048	3,795	3,232	1,947	1,223	482	668	251	661
Below Normal (13%)	471	650	582	1,075	2,047	1,110	1,061	821	434	513	254	214
Dry (24%)	342	471	467	980	1,444	1,396	1,081	720	423	316	256	191
Critical (15%)	254	296	418	714	856	747	621	462	346	249	233	179

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	266	65	62	-228	-230	-356	210	308	13	96	17	901
20%	311	491	105	-152	-20	-207	227	181	-73	95	5	894
30%	312	503	58	320	271	182	304	283	-64	78	0	675
40%	172	369	127	221	-25	30	326	201	-103	9	0	424
50%	11	318	139	220	150	45	379	138	-84	17	0	36
60%	0	101	-23	216	226	99	304	102	-62	0	0	23
70%	0	0	-4	128	117	156	219	66	-31	1	0	0
80%	0	0	9	67	125	31	144	25	-52	0	14	0
90%	-27	3	0	81	71	61	94	25	-47	0	15	0
Long Term												
Full Simulation Period ^b	115	184	4	120	59	13	237	151	-63	42	5	328
Water Year Types^c												
Wet (32%)	177	229	-105	46	-6	-86	278	233	-92	61	2	813
Above Normal (16%)	81	201	114	202	-27	-79	332	196	-80	67	2	437
Below Normal (13%)	180	217	37	196	-16	32	248	102	-99	76	-1	8
Dry (24%)	82	175	28	165	175	160	201	85	-31	6	14	0
Critical (15%)	14	52	53	45	166	67	96	76	0	0	3	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1 **C.16. X2 Position**


Figure C-16-1-1. X2, February Average Position

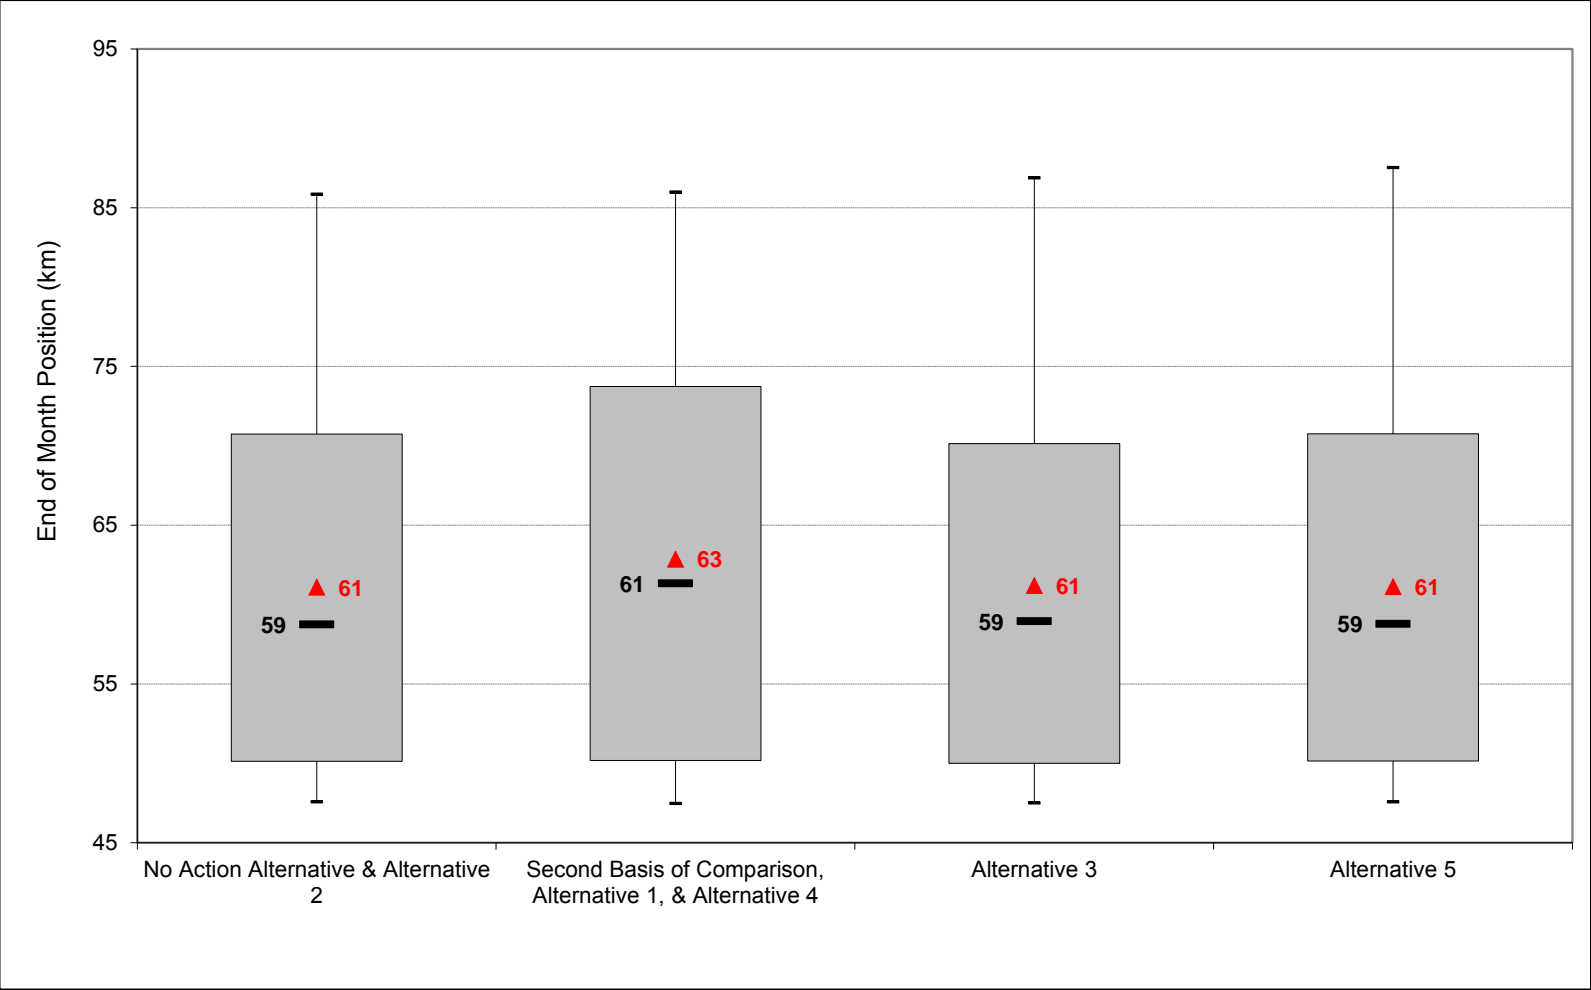

(Box=25th to 75th percentile range, whiskers=min and max, dash=median, triangle=mean)

Notes: 1) X2 is defined as the position of the 2% (grams of salt per kilogram of seawater) bottom salinity value along the axis of the estuary; measured in kilometers from the Golden Gate Bridge. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


Figure C-16-1-2. X2, March Average Position

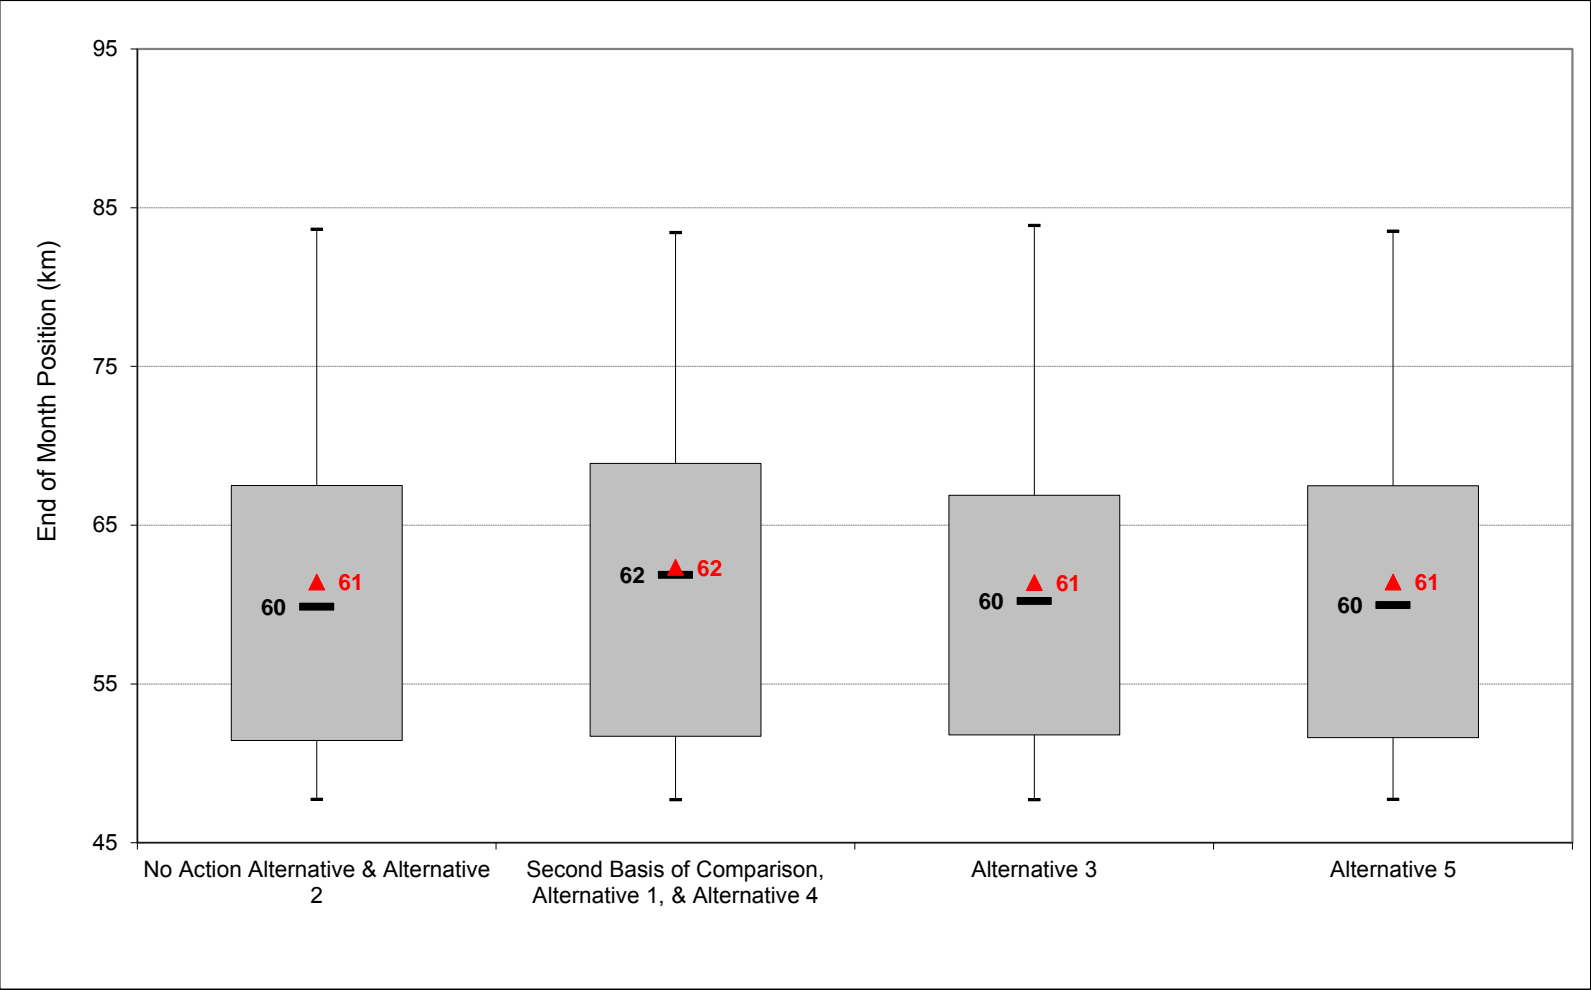

(Box=25th to 75th percentile range, whiskers=min and max, dash=median, triangle=mean)

Notes: 1) X2 is defined as the position of the 2% (grams of salt per kilogram of seawater) bottom salinity value along the axis of the estuary; measured in kilometers from the Golden Gate Bridge. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


Figure C-16-1-3. X2, April Average Position

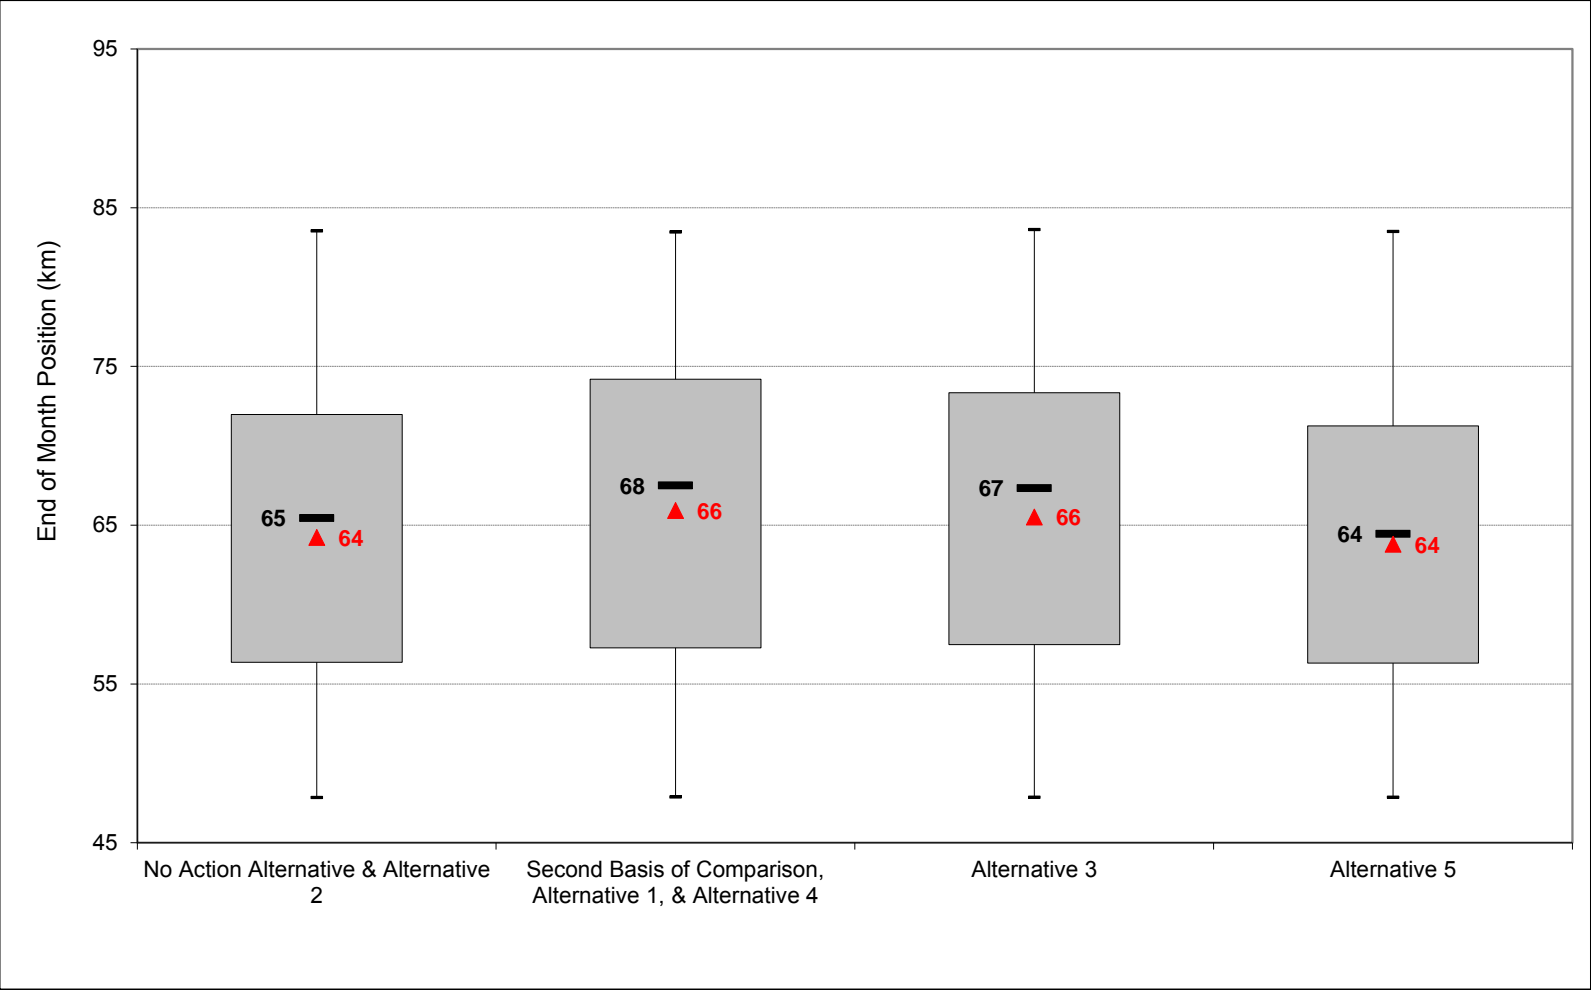

(Box=25th to 75th percentile range, whiskers=min and max, dash=median, triangle=mean)

Notes: 1) X2 is defined as the position of the 2% (grams of salt per kilogram of seawater) bottom salinity value along the axis of the estuary; measured in kilometers from the Golden Gate Bridge. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


Figure C-16-1-4. X2, May Average Position

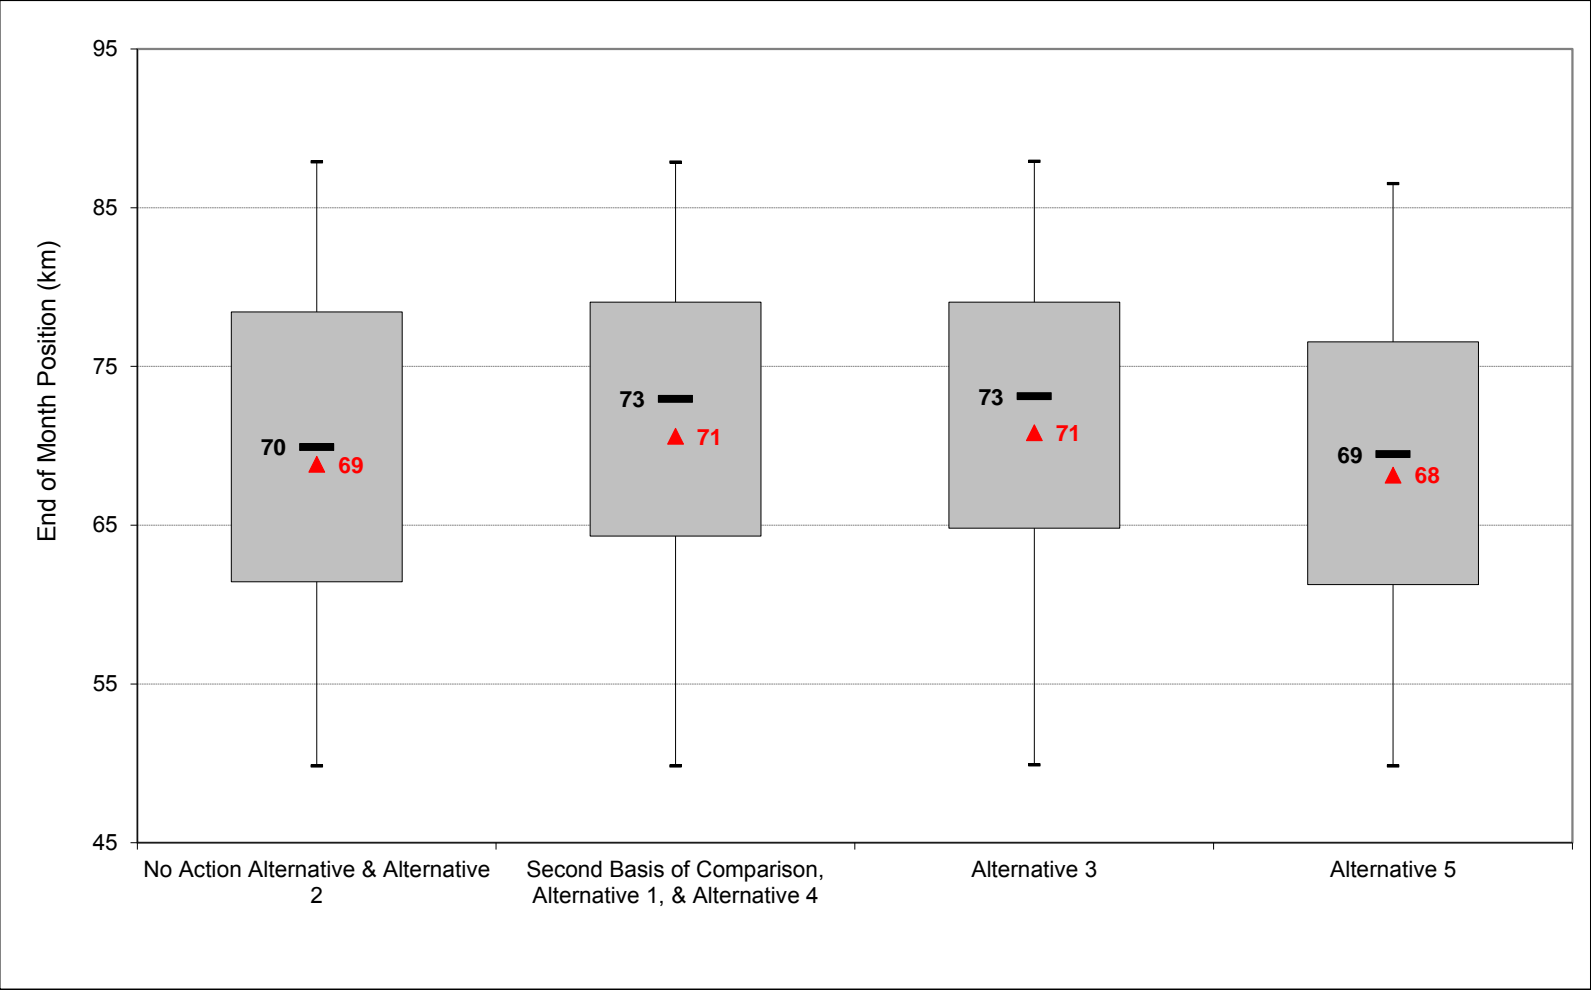

(Box=25th to 75th percentile range, whiskers=min and max, dash=median, triangle=mean)

Notes: 1) X2 is defined as the position of the 2% (grams of salt per kilogram of seawater) bottom salinity value along the axis of the estuary; measured in kilometers from the Golden Gate Bridge. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


Figure C-16-1-5. X2, June Average Position

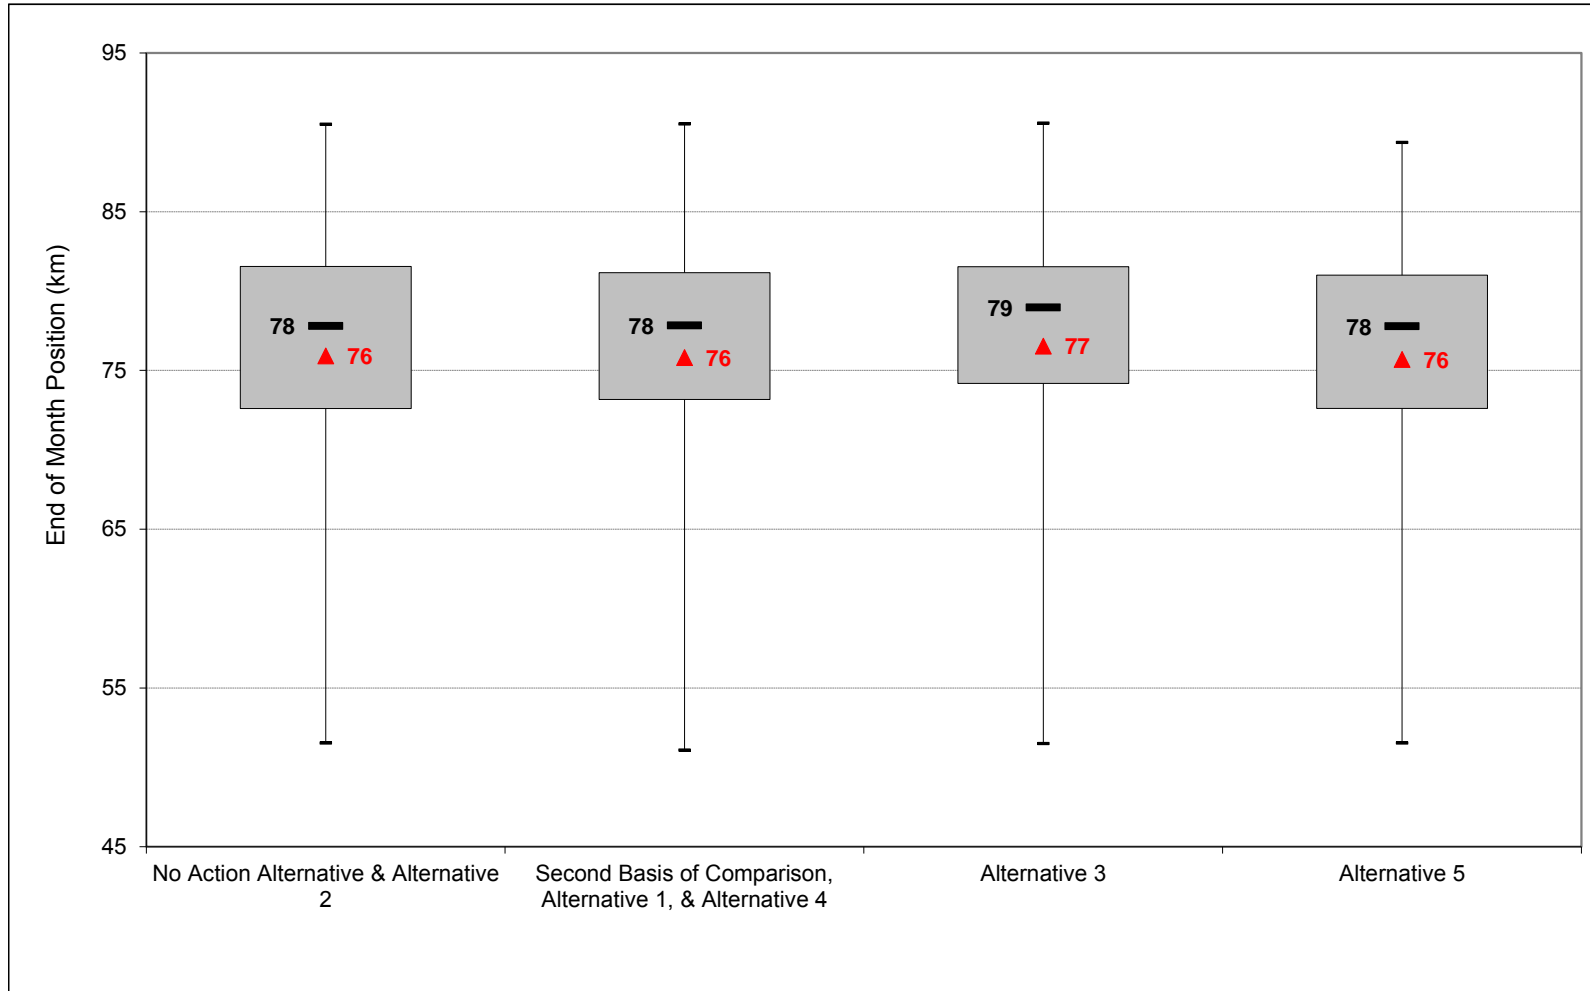

(Box=25th to 75th percentile range, whiskers=min and max, dash=median, triangle=mean)

Notes: 1) X2 is defined as the position of the 2% (grams of salt per kilogram of seawater) bottom salinity value along the axis of the estuary; measured in kilometers from the Golden Gate Bridge. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


Figure C-16-1-6. X2, September Average Position

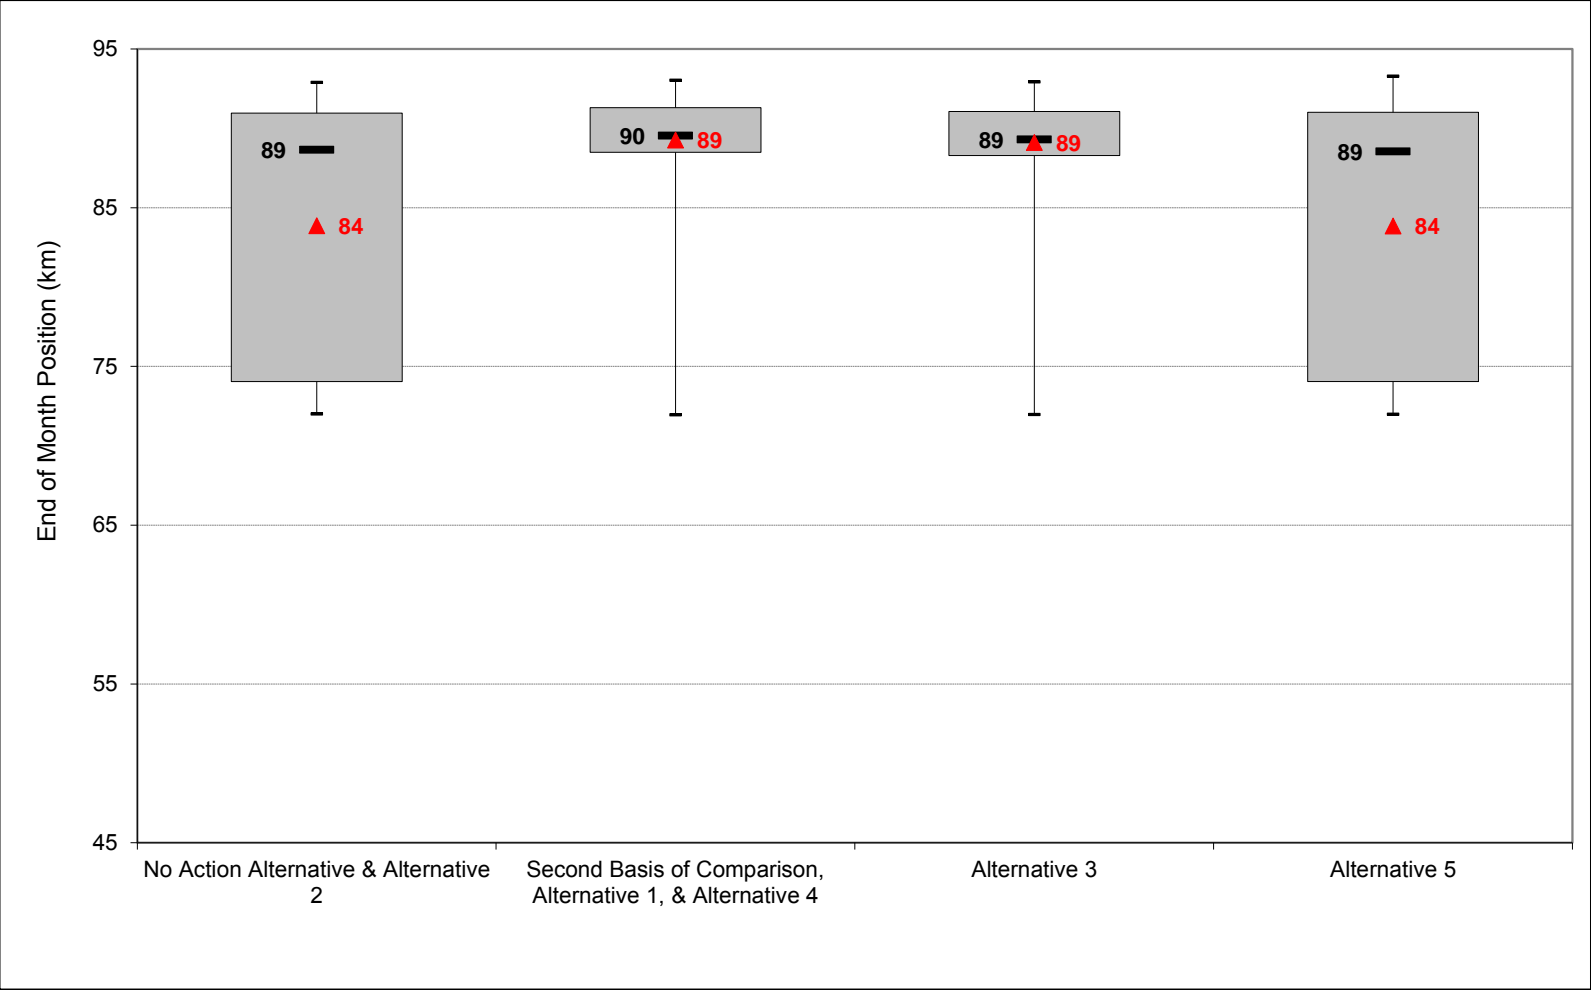

(Box=25th to 75th percentile range, whiskers=min and max, dash=median, triangle=mean)

Notes: 1) X2 is defined as the position of the 2% (grams of salt per kilogram of seawater) bottom salinity value along the axis of the estuary; measured in kilometers from the Golden Gate Bridge. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


Figure C-16-1-7. X2, October Average Position

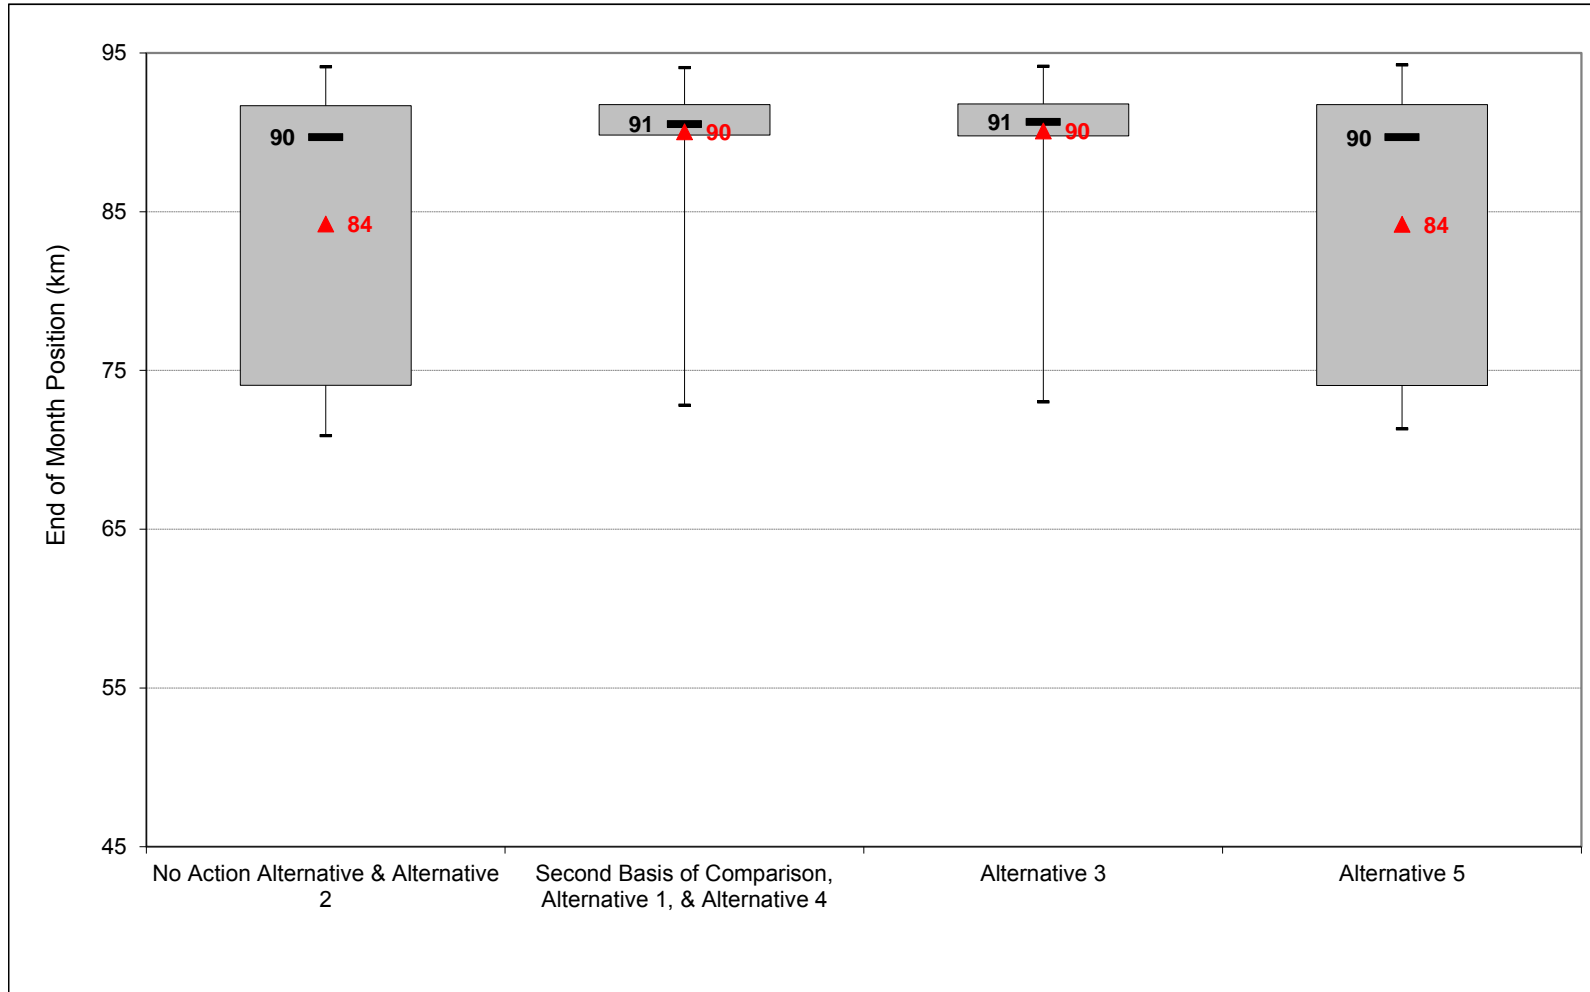

(Box=25th to 75th percentile range, whiskers=min and max, dash=median, triangle=mean)

Notes: 1) X2 is defined as the position of the 2% (grams of salt per kilogram of seawater) bottom salinity value along the axis of the estuary; measured in kilometers from the Golden Gate Bridge. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


Figure C-16-1-8. X2, November Average Position

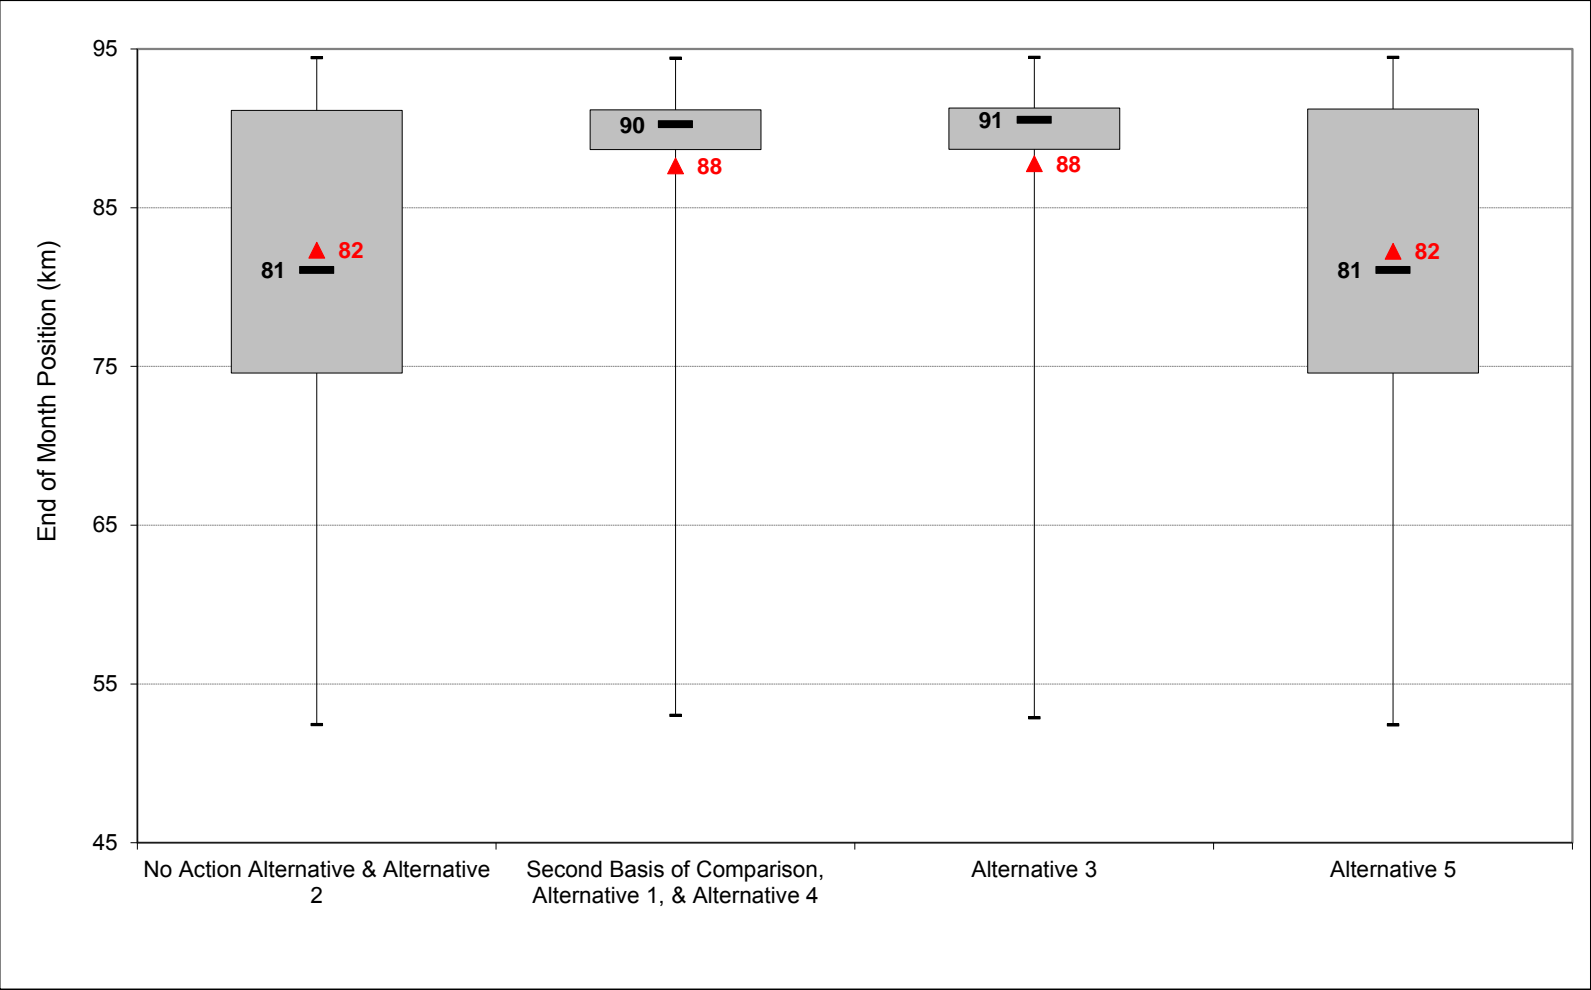

(Box=25th to 75th percentile range, whiskers=min and max, dash=median, triangle=mean)

Notes: 1) X2 is defined as the position of the 2% (grams of salt per kilogram of seawater) bottom salinity value along the axis of the estuary; measured in kilometers from the Golden Gate Bridge. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


Figure C-16-2-1. X2, Long-Term* Average Position

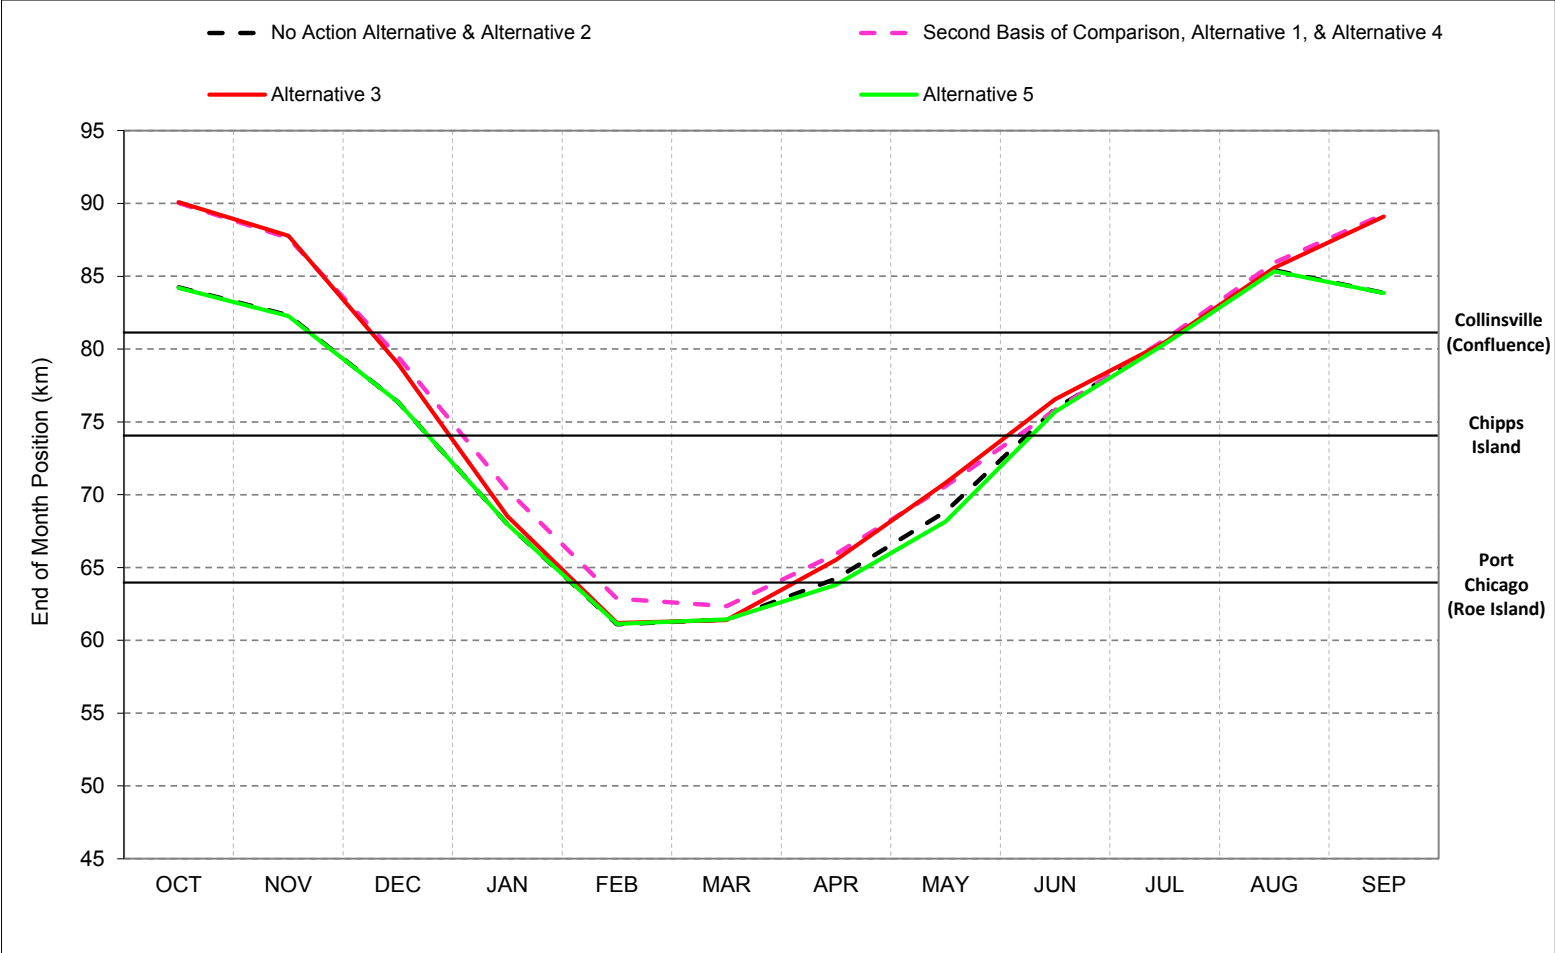

*Based on the 82-year simulation period.

Notes: 1) X2 is defined as the position of the 2% (grams of salt per kilogram of seawater) bottom salinity value along the axis of the estuary; measured in kilometers from the Golden Gate Bridge. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-16-2-2. X2, Wet Year* Long-Term** Average Position

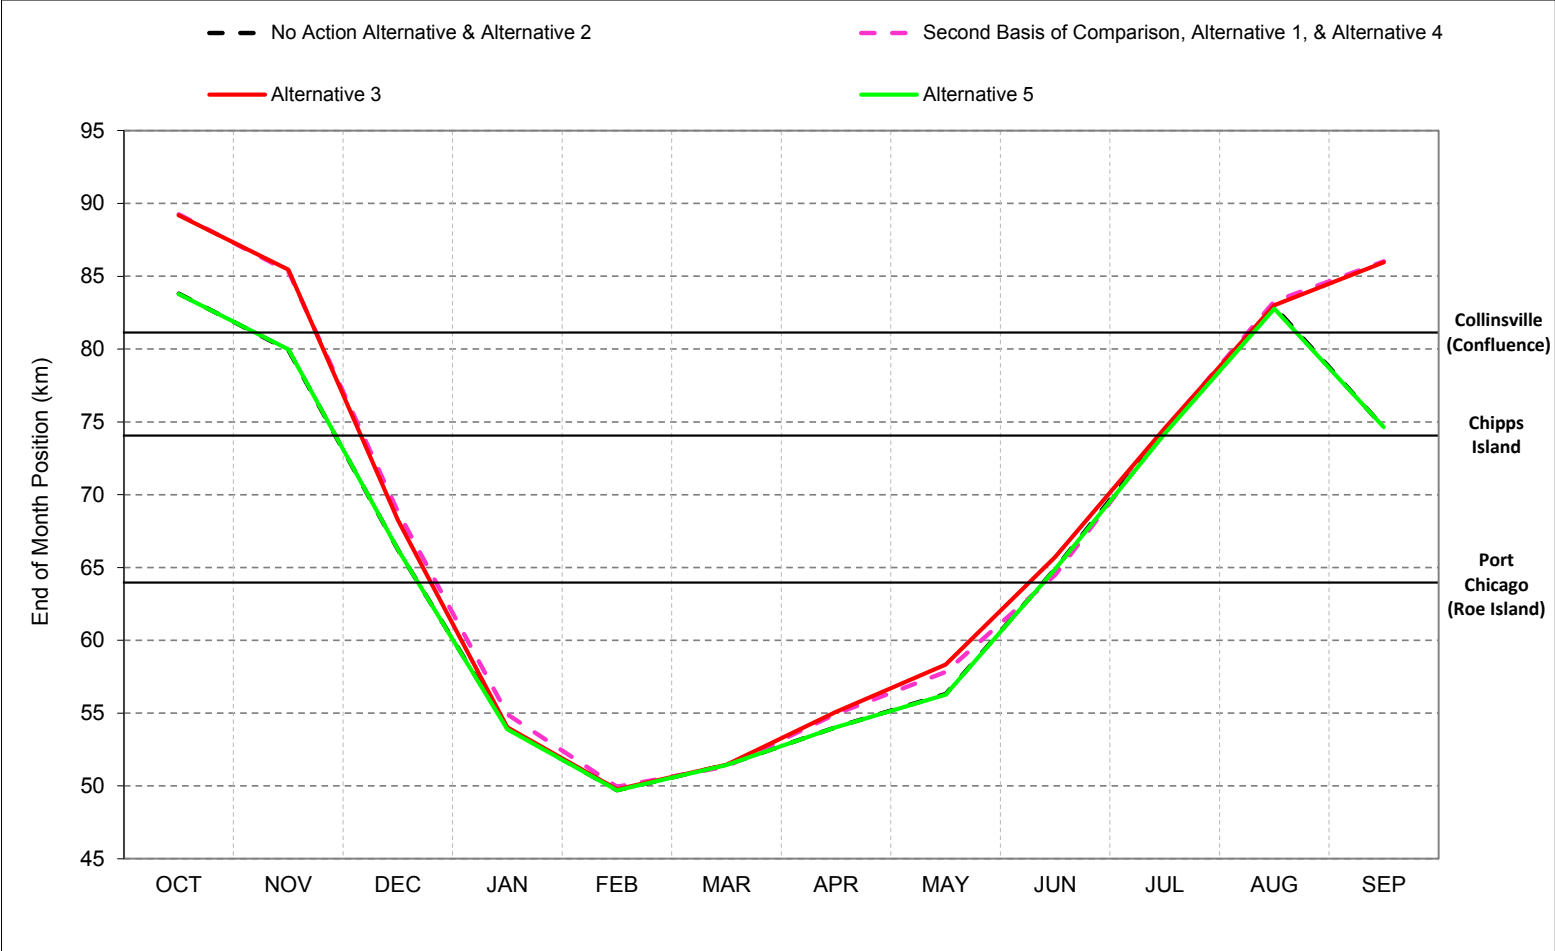


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) X2 is defined as the position of the 2% (grams of salt per kilogram of seawater) bottom salinity value along the axis of the estuary; measured in kilometers from the Golden Gate Bridge. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-16-2-3. X2, Above Normal Year* Long-Term** Average Position

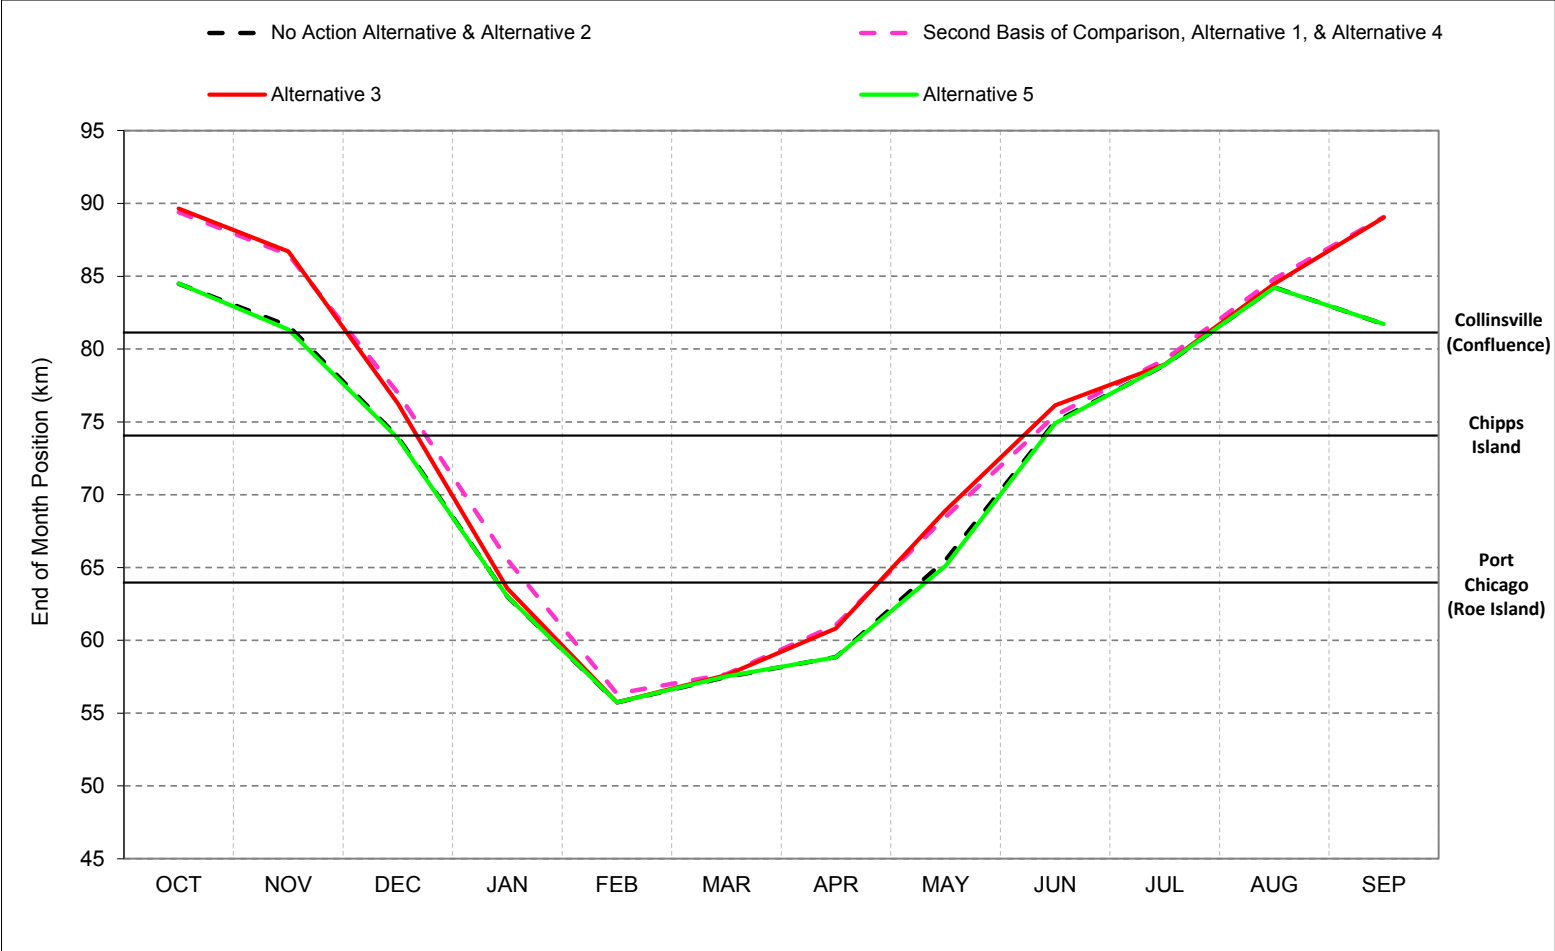


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) X2 is defined as the position of the 2% (grams of salt per kilogram of seawater) bottom salinity value along the axis of the estuary; measured in kilometers from the Golden Gate Bridge. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-16-2-4. X2, Below Normal Year* Long-Term** Average Position

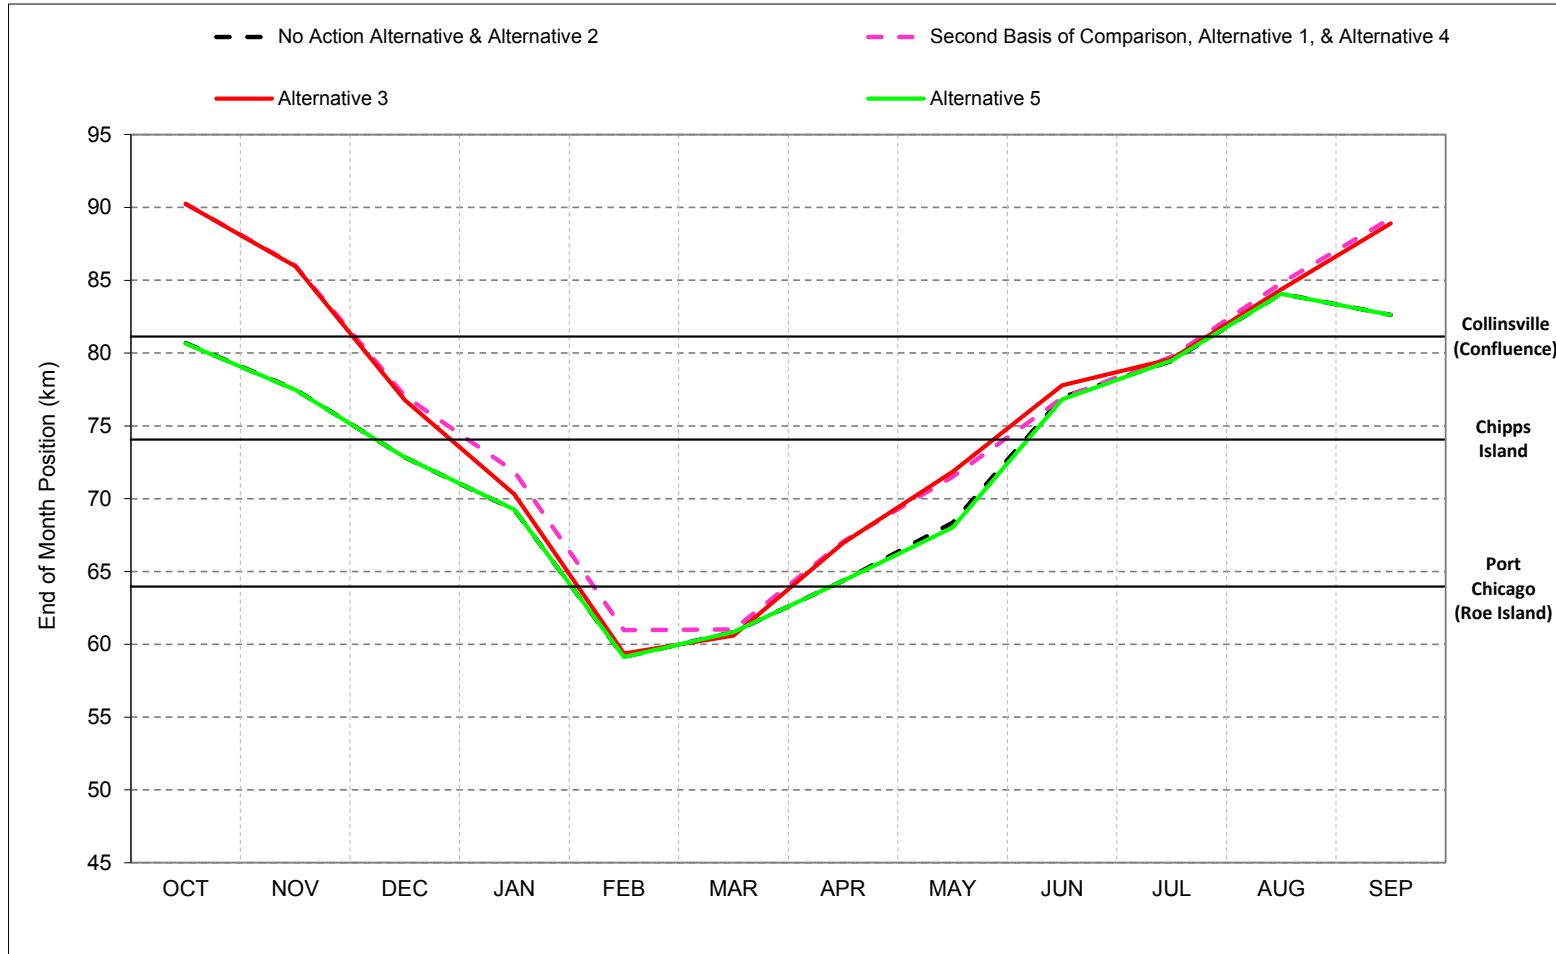


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) X2 is defined as the position of the 2% (grams of salt per kilogram of seawater) bottom salinity value along the axis of the estuary; measured in kilometers from the Golden Gate Bridge. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-16-2-5. X2, Dry Year* Long-Term** Average Position

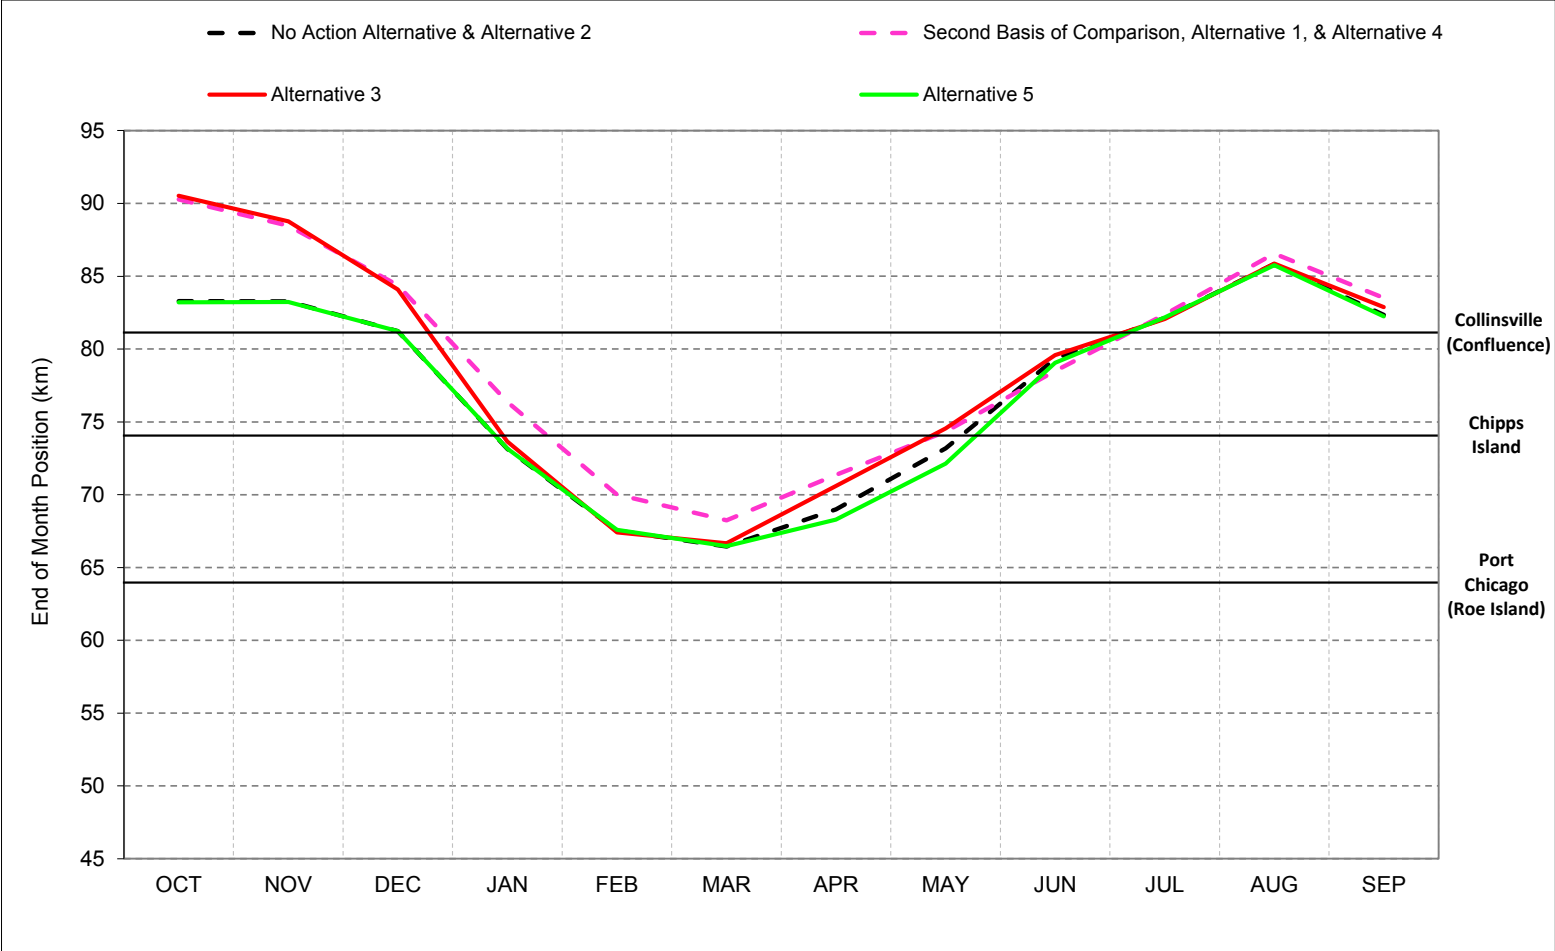


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) X2 is defined as the position of the 2% (grams of salt per kilogram of seawater) bottom salinity value along the axis of the estuary; measured in kilometers from the Golden Gate Bridge. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-16-2-6. X2, Critical Year* Long-Term** Average Position

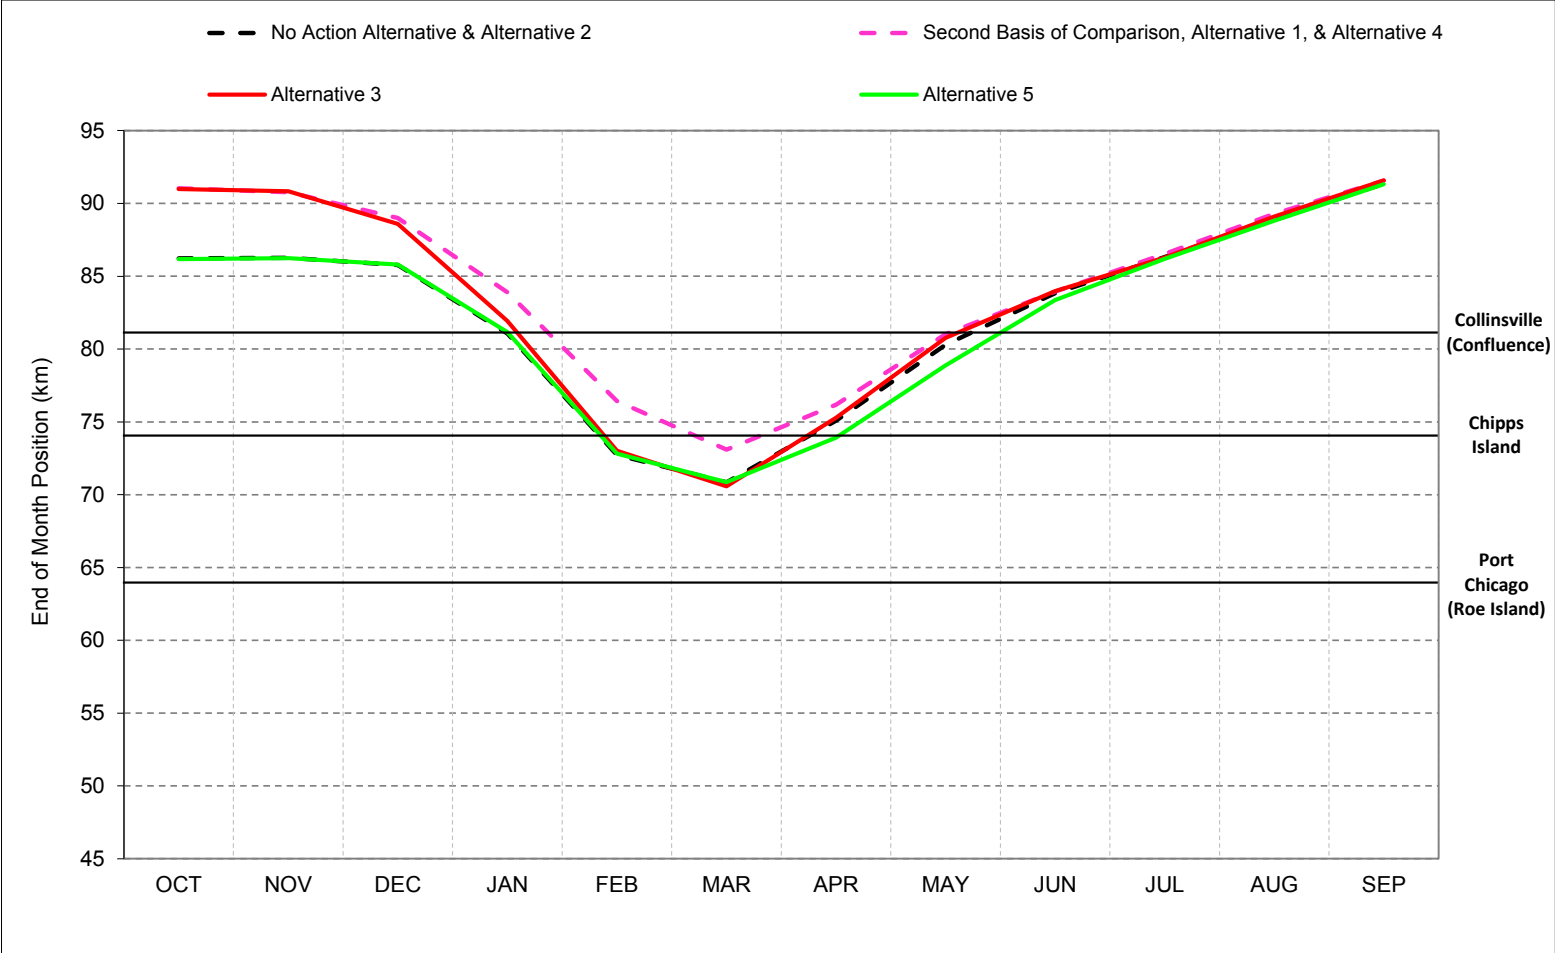

*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) X2 is defined as the position of the 2% (grams of salt per kilogram of seawater) bottom salinity value along the axis of the estuary; measured in kilometers from the Golden Gate Bridge. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-16-1. X2, End of Month Position

No Action Alternative												
Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	93.4	93.6	90.8	84.0	77.3	75.9	78.1	81.0	83.1	86.5	89.7	91.9
20%	91.8	91.4	87.6	82.3	71.7	72.8	73.6	79.3	81.8	84.9	88.1	91.1
30%	91.6	90.9	83.9	79.8	67.2	65.7	70.0	77.3	81.0	84.3	87.5	90.6
40%	91.1	88.1	82.5	73.5	64.0	64.5	66.7	72.3	80.2	82.4	86.2	90.1
50%	89.7	81.1	81.1	71.2	58.5	59.9	64.7	69.9	77.8	80.6	84.8	88.5
60%	81.0	81.0	79.7	64.4	55.2	58.0	60.9	66.3	76.6	78.1	84.6	81.0
70%	74.1	75.1	72.0	55.1	51.9	53.9	58.0	63.8	73.4	77.4	84.1	74.1
80%	74.0	74.0	62.2	51.3	49.4	50.6	53.8	59.1	69.8	76.8	82.7	74.0
90%	74.0	74.0	52.8	49.4	48.2	49.0	49.9	53.3	63.5	74.6	82.2	74.0
Long Term												
Full Simulation Period ^b	84.2	82.3	76.4	68.0	61.1	61.4	64.2	68.8	75.9	80.4	85.4	83.9
Water Year Types^c												
Wet (32%)	73.9	72.9	71.1	54.8	51.2	53.1	55.1	58.4	67.4	74.9	82.7	73.9
Above Normal (16%)	81.0	79.3	75.9	61.0	54.9	55.3	59.1	65.2	75.3	77.9	83.1	74.7
Below Normal (13%)	89.1	87.6	78.8	74.6	64.3	66.9	69.0	72.9	79.1	81.1	85.1	89.3
Dry (24%)	91.5	86.9	75.4	77.7	67.7	65.4	68.8	74.5	80.1	84.5	87.6	90.5
Critical (15%)	93.6	93.6	87.8	82.0	75.3	74.6	77.7	82.3	85.2	87.9	90.3	92.1

Alternative 1												
Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	92.6	93.1	90.9	87.3	80.8	78.5	78.7	81.5	83.5	86.7	89.9	92.0
20%	91.9	91.4	90.6	85.8	75.6	73.6	75.2	79.5	81.6	84.8	88.6	91.5
30%	91.4	91.0	89.6	83.3	72.0	68.3	73.1	78.5	80.6	84.3	88.0	91.0
40%	91.0	90.8	88.6	78.8	66.2	66.5	69.7	75.3	78.7	82.0	86.6	90.1
50%	90.5	90.3	86.7	75.6	61.4	61.6	67.4	72.9	77.8	80.9	85.3	89.5
60%	90.3	89.6	82.5	67.7	55.7	57.8	64.1	69.2	76.2	79.1	84.7	89.0
70%	90.0	89.1	76.9	56.2	52.4	54.1	59.7	66.0	74.4	78.3	84.5	88.7
80%	89.6	88.0	65.9	52.0	49.3	50.4	54.7	60.2	71.4	77.3	84.0	88.4
90%	88.2	79.6	53.3	49.5	48.3	48.8	50.4	54.6	63.9	74.7	83.0	87.8
Long Term												
Full Simulation Period ^b	90.0	87.6	79.5	70.3	62.9	62.3	65.9	70.6	75.8	80.6	85.9	89.3
Water Year Types^c												
Wet (32%)	87.8	84.8	75.8	55.7	51.6	53.0	56.4	60.2	67.2	75.2	83.3	86.7
Above Normal (16%)	90.3	87.9	80.5	63.6	56.0	55.2	61.2	67.9	75.1	78.2	83.8	81.9
Below Normal (13%)	89.4	88.6	80.6	78.7	66.4	67.6	71.3	74.9	78.2	81.3	85.9	89.7
Dry (24%)	91.2	87.2	76.9	81.1	70.8	67.5	70.7	75.9	80.2	84.4	88.1	90.9
Critical (15%)	93.1	93.4	89.8	83.6	78.1	76.7	78.8	83.3	85.7	88.2	90.6	92.3

Alternative 1 minus No Action Alternative												
Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-0.7	-0.5	0.1	3.3	3.5	2.6	0.5	0.5	0.3	0.2	0.2	0.1
20%	0.1	-0.1	3.0	3.6	3.9	0.8	1.6	0.3	-0.2	-0.1	0.5	0.4
30%	-0.2	0.1	5.6	3.5	4.8	2.5	3.1	1.3	-0.4	0.0	0.6	0.4
40%	-0.1	2.7	6.1	5.3	2.2	2.0	3.0	3.0	-1.5	-0.4	0.3	0.0
50%	0.8	9.2	5.6	4.4	3.0	1.7	2.7	3.0	0.0	0.3	0.5	1.1
60%	9.3	8.6	2.7	3.4	0.5	-0.2	3.3	2.9	-0.4	1.0	0.1	8.0
70%	15.9	14.0	5.0	1.1	0.5	0.2	1.7	2.2	1.0	0.9	0.4	14.6
80%	15.6	13.9	3.6	0.7	-0.1	-0.2	0.9	1.0	1.6	0.4	1.3	14.4
90%	14.2	5.6	0.5	0.1	0.1	-0.2	0.5	1.2	0.4	0.1	0.8	13.8
Long Term												
Full Simulation Period ^b	5.8	5.3	3.1	2.4	1.8	0.9	1.7	1.8	-0.1	0.2	0.5	5.4
Water Year Types^c												
Wet	13.9	11.9	4.7	0.9	0.4	0.0	1.3	1.9	-0.1	0.4	0.5	12.7
Above Normal	9.3	8.6	4.5	2.6	1.1	0.0	2.1	2.7	-0.2	0.3	0.7	7.2
Below Normal	0.3	1.0	1.8	4.2	2.1	0.8	2.3	2.0	-0.9	0.2	0.8	0.4
Dry	-0.2	0.3	1.5	3.5	3.2	2.2	1.9	1.4	0.1	-0.1	0.4	0.3
Critical	-0.5	-0.2	2.0	1.6	2.9	2.2	1.2	0.9	0.5	0.3	0.3	0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) X2 is defined as the position of the 2‰ (grams of salt per kilogram of seawater) bottom salinity value along the axis of the estuary, measured in kilometers from the Golden Gate Bridge. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-16-2. X2, End of Month Position

No Action Alternative												
Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	93.4	93.6	90.8	84.0	77.3	75.9	78.1	81.0	83.1	86.5	89.7	91.9
20%	91.8	91.4	87.6	82.3	71.7	72.8	73.6	79.3	81.8	84.9	88.1	91.1
30%	91.6	90.9	83.9	79.8	67.2	65.7	70.0	77.3	81.0	84.3	87.5	90.6
40%	91.1	88.1	82.5	73.5	64.0	64.5	66.7	72.3	80.2	82.4	86.2	90.1
50%	89.7	81.1	81.1	71.2	58.5	59.9	64.7	69.9	77.8	80.6	84.8	88.5
60%	81.0	81.0	79.7	64.4	55.2	58.0	60.9	66.3	76.6	78.1	84.6	81.0
70%	74.1	75.1	72.0	55.1	51.9	53.9	58.0	63.8	73.4	77.4	84.1	74.1
80%	74.0	74.0	62.2	51.3	49.4	50.6	53.8	59.1	69.8	76.8	82.7	74.0
90%	74.0	74.0	52.8	49.4	48.2	49.0	49.9	53.3	63.5	74.6	82.2	74.0
Long Term												
Full Simulation Period ^b	84.2	82.3	76.4	68.0	61.1	61.4	64.2	68.8	75.9	80.4	85.4	83.9
Water Year Types ^c												
Wet (32%)	73.9	72.9	71.1	54.8	51.2	53.1	55.1	58.4	67.4	74.9	82.7	73.9
Above Normal (16%)	81.0	79.3	75.9	61.0	54.9	55.3	59.1	65.2	75.3	77.9	83.1	74.7
Below Normal (13%)	89.1	87.6	78.8	74.6	64.3	66.9	69.0	72.9	79.1	81.1	85.1	89.3
Dry (24%)	91.5	86.9	75.4	77.7	67.7	65.4	68.8	74.5	80.1	84.5	87.6	90.5
Critical (15%)	93.6	93.6	87.8	82.0	75.3	74.6	77.7	82.3	85.2	87.9	90.3	92.1

Alternative 3												
Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	93.2	93.6	90.8	86.1	77.8	75.8	78.2	81.5	83.2	86.4	90.0	92.2
20%	91.9	91.5	90.5	83.7	71.7	72.5	74.6	79.6	82.0	84.8	88.4	91.3
30%	91.6	91.1	89.4	81.5	67.6	66.1	71.3	78.4	81.0	84.3	87.7	90.8
40%	91.2	90.8	88.5	74.8	64.1	64.5	69.7	75.6	80.3	81.7	86.0	89.8
50%	90.7	90.6	86.7	71.8	58.8	60.0	67.3	73.1	78.8	80.7	84.9	89.3
60%	90.2	89.8	82.6	64.6	54.4	58.0	63.6	70.4	77.1	78.4	84.6	88.7
70%	89.9	89.0	74.2	55.1	52.2	54.4	59.9	66.8	75.1	77.8	84.2	88.4
80%	89.6	87.9	65.1	51.2	49.3	50.4	54.8	61.7	71.8	77.1	83.2	88.2
90%	88.2	79.6	53.0	49.5	48.1	48.8	50.4	54.8	64.9	75.0	82.4	87.6
Long Term												
Full Simulation Period ^b	90.1	87.8	79.0	68.5	61.2	61.4	65.5	70.8	76.5	80.5	85.6	89.1
Water Year Types ^c												
Wet (32%)	87.8	84.8	75.3	54.8	51.3	53.1	56.5	60.8	68.3	75.1	82.9	86.6
Above Normal (16%)	90.3	88.0	80.0	61.5	54.9	55.0	60.9	68.4	76.2	78.0	83.4	81.8
Below Normal (13%)	89.2	88.8	80.2	75.4	64.0	66.6	70.5	74.9	79.6	81.0	85.1	89.2
Dry (24%)	91.4	87.4	76.4	78.8	67.9	65.5	69.9	76.0	80.4	84.3	87.8	90.8
Critical (15%)	93.4	93.7	89.3	82.7	75.6	74.6	78.1	82.8	85.4	88.0	90.5	92.3

Alternative 3 minus No Action Alternative												
Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.2	-0.1	0.0	2.1	0.5	-0.1	0.0	0.4	0.0	-0.1	0.3	0.3
20%	0.1	0.0	2.8	1.4	0.0	-0.2	1.1	0.3	0.2	-0.1	0.3	0.3
30%	0.0	0.2	5.5	1.7	0.4	0.4	1.2	1.2	0.0	0.0	0.2	0.2
40%	0.1	2.7	5.9	1.3	0.1	0.0	3.0	3.3	0.2	-0.6	-0.2	-0.3
50%	1.0	9.5	5.6	0.6	0.4	0.2	2.5	3.3	1.1	0.1	0.1	0.8
60%	9.2	8.8	2.9	0.2	-0.8	0.1	2.7	4.1	0.5	0.3	0.0	7.7
70%	15.8	13.9	2.2	0.0	0.3	0.4	1.8	2.9	1.7	0.3	0.1	14.4
80%	15.5	13.9	2.9	-0.1	0.0	-0.2	1.0	2.6	1.9	0.3	0.5	14.1
90%	14.2	5.7	0.2	0.1	-0.1	-0.2	0.5	1.5	1.4	0.4	0.1	13.6
Long Term												
Full Simulation Period ^b	5.9	5.5	2.6	0.6	0.1	0.0	1.3	2.0	0.6	0.0	0.2	5.2
Water Year Types ^c												
Wet	13.9	11.9	4.3	0.0	0.1	0.1	1.4	2.4	1.0	0.2	0.1	12.6
Above Normal	9.3	8.7	4.0	0.5	0.0	-0.2	1.9	3.2	0.9	0.1	0.3	7.0
Below Normal	0.1	1.2	1.4	0.8	-0.3	-0.3	1.6	2.1	0.5	-0.1	0.0	-0.1
Dry	-0.1	0.5	1.0	1.1	0.2	0.1	1.2	1.5	0.3	-0.2	0.2	0.2
Critical	-0.1	0.1	1.4	0.7	0.3	0.0	0.4	0.5	0.2	0.1	0.2	0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) X2 is defined as the position of the 2% (grams of salt per kilogram of seawater) bottom salinity value along the axis of the estuary, measured in kilometers from the Golden Gate Bridge. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-16-3. X2, End of Month Position

No Action Alternative												
Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	93.4	93.6	90.8	84.0	77.3	75.9	78.1	81.0	83.1	86.5	89.7	91.9
20%	91.8	91.4	87.6	82.3	71.7	72.8	73.6	79.3	81.8	84.9	88.1	91.1
30%	91.6	90.9	83.9	79.8	67.2	65.7	70.0	77.3	81.0	84.3	87.5	90.6
40%	91.1	88.1	82.5	73.5	64.0	64.5	66.7	72.3	80.2	82.4	86.2	90.1
50%	89.7	81.1	81.1	71.2	58.5	59.9	64.7	69.9	77.8	80.6	84.8	88.5
60%	81.0	81.0	79.7	64.4	55.2	58.0	60.9	66.3	76.6	78.1	84.6	81.0
70%	74.1	75.1	72.0	55.1	51.9	53.9	58.0	63.8	73.4	77.4	84.1	74.1
80%	74.0	74.0	62.2	51.3	49.4	50.6	53.8	59.1	69.8	76.8	82.7	74.0
90%	74.0	74.0	52.8	49.4	48.2	49.0	49.9	53.3	63.5	74.6	82.2	74.0
Long Term												
Full Simulation Period ^b	84.2	82.3	76.4	68.0	61.1	61.4	64.2	68.8	75.9	80.4	85.4	83.9
Water Year Types^c												
Wet (32%)	73.9	72.9	71.1	54.8	51.2	53.1	55.1	58.4	67.4	74.9	82.7	73.9
Above Normal (16%)	81.0	79.3	75.9	61.0	54.9	55.3	59.1	65.2	75.3	77.9	83.1	74.7
Below Normal (13%)	89.1	87.6	78.8	74.6	64.3	66.9	69.0	72.9	79.1	81.1	85.1	89.3
Dry (24%)	91.5	86.9	75.4	77.7	67.7	65.4	68.8	74.5	80.1	84.5	87.6	90.5
Critical (15%)	93.6	93.6	87.8	82.0	75.3	74.6	77.7	82.3	85.2	87.9	90.3	92.1

Alternative 5												
Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	93.2	93.3	90.8	84.0	77.3	75.9	77.2	79.1	83.1	86.5	89.6	91.9
20%	91.9	91.5	87.6	82.3	71.7	72.8	72.5	77.9	81.4	84.9	88.1	91.1
30%	91.6	91.0	83.9	79.8	67.2	65.8	69.5	75.8	81.0	84.2	87.4	90.5
40%	91.0	88.0	82.4	73.5	63.9	64.5	66.4	71.5	79.6	82.3	86.1	90.0
50%	89.5	81.1	81.2	71.2	58.5	59.9	64.2	69.3	77.8	80.7	84.8	88.5
60%	81.0	81.0	79.7	64.4	55.1	57.9	60.8	66.4	76.6	78.2	84.6	81.0
70%	74.1	75.1	71.9	55.1	51.9	53.9	58.0	63.7	73.4	77.5	84.1	74.1
80%	74.0	74.1	62.2	51.3	49.4	50.6	53.5	58.9	69.8	76.8	82.6	74.0
90%	74.0	73.9	53.0	49.4	48.2	49.1	49.9	53.3	63.5	74.6	82.2	74.0
Long Term												
Full Simulation Period ^b	84.2	82.3	76.4	68.0	61.1	61.4	63.8	68.2	75.7	80.4	85.3	83.8
Water Year Types^c												
Wet (32%)	73.9	72.9	71.1	54.7	51.2	53.1	55.1	58.2	67.3	74.7	82.6	73.9
Above Normal (16%)	81.0	79.2	75.9	60.9	54.9	55.3	59.0	65.0	75.2	77.9	83.1	74.8
Below Normal (13%)	89.1	87.2	78.6	74.6	64.3	66.9	68.4	72.1	79.0	81.1	85.0	89.3
Dry (24%)	91.4	87.0	75.4	77.7	67.7	65.4	67.9	73.4	79.8	84.5	87.6	90.5
Critical (15%)	93.5	93.5	87.9	82.1	75.5	74.6	76.7	80.8	84.5	87.7	90.2	92.1

Alternative 5 minus No Action Alternative												
Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-0.2	-0.3	0.0	0.0	0.0	0.0	-1.0	-1.9	-0.1	0.0	-0.1	0.0
20%	0.1	0.0	0.0	0.0	0.0	0.0	-1.1	-1.3	-0.3	0.0	0.0	0.0
30%	0.0	0.1	0.0	0.0	0.0	0.0	-0.5	-1.4	-0.1	-0.1	-0.1	-0.1
40%	-0.1	-0.1	-0.2	0.0	0.0	0.0	-0.3	-0.8	-0.6	-0.1	-0.1	-0.1
50%	-0.1	0.0	0.0	0.0	0.0	0.1	-0.5	-0.5	0.0	0.1	0.0	0.0
60%	0.0	0.0	0.0	0.1	-0.1	0.0	-0.1	0.1	0.0	0.0	0.0	0.0
70%	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	-0.1	0.0	0.0	-0.2	-0.2	0.0	0.0	-0.1	0.0
90%	0.0	0.0	0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0
Long Term												
Full Simulation Period ^b	0.0	-0.1	0.0	0.0	0.0	0.0	-0.4	-0.7	-0.2	-0.1	-0.1	0.0
Water Year Types^c												
Wet	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.2	0.0	-0.1	-0.1	0.0
Above Normal	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.2	-0.1	0.0	0.0	0.0
Below Normal	0.0	-0.4	-0.2	0.0	0.0	0.0	-0.5	-0.8	-0.1	0.0	-0.1	-0.1
Dry	0.0	0.1	0.0	0.1	0.0	0.0	-0.9	-1.1	-0.3	0.0	0.0	0.0
Critical	-0.1	-0.1	0.0	0.2	0.2	0.1	-0.9	-1.6	-0.7	-0.2	-0.1	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) X2 is defined as the position of the 2% (grams of salt per kilogram of seawater) bottom salinity value along the axis of the estuary, measured in kilometers from the Golden Gate Bridge. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-16-4. X2, End of Month Position

Second Basis of Comparison		End of Month Position (km)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	92.6	93.1	90.9	87.3	80.8	78.5	78.7	81.5	83.5	86.7	89.9	92.0	
20%	91.9	91.4	90.6	85.8	75.6	73.6	75.2	79.5	81.6	84.8	88.6	91.5	
30%	91.4	91.0	89.6	83.3	72.0	68.3	73.1	78.5	80.6	84.3	88.0	91.0	
40%	91.0	90.8	88.6	78.8	66.2	66.5	69.7	75.3	78.7	82.0	86.6	90.1	
50%	90.5	90.3	86.7	75.6	61.4	61.6	67.4	72.9	77.8	80.9	85.3	89.5	
60%	90.3	89.6	82.5	67.7	55.7	57.8	64.1	69.2	76.2	79.1	84.7	89.0	
70%	90.0	89.1	76.9	56.2	52.4	54.1	59.7	66.0	74.4	78.3	84.5	88.7	
80%	89.6	88.0	65.9	52.0	49.3	50.4	54.7	60.2	71.4	77.3	84.0	88.4	
90%	88.2	79.6	53.3	49.5	48.3	48.8	50.4	54.6	63.9	74.7	83.0	87.8	
Long Term													
Full Simulation Period ^b	90.0	87.6	79.5	70.3	62.9	62.3	65.9	70.6	75.8	80.6	85.9	89.3	
Water Year Types^c													
Wet (32%)	87.8	84.8	75.8	55.7	51.6	53.0	56.4	60.2	67.2	75.2	83.3	86.7	
Above Normal (16%)	90.3	87.9	80.5	63.6	56.0	55.2	61.2	67.9	75.1	78.2	83.8	81.9	
Below Normal (13%)	89.4	88.6	80.6	78.7	66.4	67.6	71.3	74.9	78.2	81.3	85.9	89.7	
Dry (24%)	91.2	87.2	76.9	81.1	70.8	67.5	70.7	75.9	80.2	84.4	88.1	90.9	
Critical (15%)	93.1	93.4	89.8	83.6	78.1	76.7	78.8	83.3	85.7	88.2	90.6	92.3	

No Action Alternative		End of Month Position (km)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	93.4	93.6	90.8	84.0	77.3	75.9	78.1	81.0	83.1	86.5	89.7	91.9	
20%	91.8	91.4	87.6	82.3	71.7	72.8	73.6	79.3	81.8	84.9	88.1	91.1	
30%	91.6	90.9	83.9	79.8	67.2	65.7	70.0	77.3	81.0	84.3	87.5	90.6	
40%	91.1	88.1	82.5	73.5	64.0	64.5	66.7	72.3	80.2	82.4	86.2	90.1	
50%	89.7	81.1	81.1	71.2	58.5	59.9	64.7	69.9	77.8	80.6	84.8	88.5	
60%	81.0	81.0	79.7	64.4	55.2	58.0	60.9	66.3	76.6	78.1	84.6	81.0	
70%	74.1	75.1	72.0	55.1	51.9	53.9	58.0	63.8	73.4	77.4	84.1	74.1	
80%	74.0	74.0	62.2	51.3	49.4	50.6	53.8	59.1	69.8	76.8	82.7	74.0	
90%	74.0	74.0	52.8	49.4	48.2	49.0	49.9	53.3	63.5	74.6	82.2	74.0	
Long Term													
Full Simulation Period ^b	84.2	82.3	76.4	68.0	61.1	61.4	64.2	68.8	75.9	80.4	85.4	83.9	
Water Year Types^c													
Wet (32%)	73.9	72.9	71.1	54.8	51.2	53.1	55.1	58.4	67.4	74.9	82.7	73.9	
Above Normal (16%)	81.0	79.3	75.9	61.0	54.9	55.3	59.1	65.2	75.3	77.9	83.1	74.7	
Below Normal (13%)	89.1	87.6	78.8	74.6	64.3	66.9	69.0	72.9	79.1	81.1	85.1	89.3	
Dry (24%)	91.5	86.9	75.4	77.7	67.7	65.4	68.8	74.5	80.1	84.5	87.6	90.5	
Critical (15%)	93.6	93.6	87.8	82.0	75.3	74.6	77.7	82.3	85.2	87.9	90.3	92.1	

No Action Alternative minus Second Basis of Comparison		End of Month Position (km)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	0.7	0.5	-0.1	-3.3	-3.5	-2.6	-0.5	-0.5	-0.3	-0.2	-0.2	-0.1	
20%	-0.1	0.1	-3.0	-3.6	-3.9	-0.8	-1.6	-0.3	0.2	0.1	-0.5	-0.4	
30%	0.2	-0.1	-5.6	-3.5	-4.8	-2.5	-3.1	-1.3	0.4	0.0	-0.6	-0.4	
40%	0.1	-2.7	-6.1	-5.3	-2.2	-2.0	-3.0	-3.0	1.5	0.4	-0.3	0.0	
50%	-0.8	-9.2	-5.6	-4.4	-3.0	-1.7	-2.7	-3.0	0.0	-0.3	-0.5	-1.1	
60%	-9.3	-8.6	-2.7	-3.4	-0.5	0.2	-3.3	-2.9	0.4	-1.0	-0.1	-8.0	
70%	-15.9	-14.0	-5.0	-1.1	-0.5	-0.2	-1.7	-2.2	-1.0	-0.9	-0.4	-14.6	
80%	-15.6	-13.9	-3.6	-0.7	0.1	0.2	-0.9	-1.0	-1.6	-0.4	-1.3	-14.4	
90%	-14.2	-5.6	-0.5	-0.1	-0.1	0.2	-0.5	-1.2	-0.4	-0.1	-0.8	-13.8	
Long Term													
Full Simulation Period ^b	-5.8	-5.3	-3.1	-2.4	-1.8	-0.9	-1.7	-1.8	0.1	-0.2	-0.5	-5.4	
Water Year Types^c													
Wet	-13.9	-11.9	-4.7	-0.9	-0.4	0.0	-1.3	-1.9	0.1	-0.4	-0.5	-12.7	
Above Normal	-9.3	-8.6	-4.5	-2.6	-1.1	0.0	-2.1	-2.7	0.2	-0.3	-0.7	-7.2	
Below Normal	-0.3	-1.0	-1.8	-4.2	-2.1	-0.8	-2.3	-2.0	0.9	-0.2	-0.8	-0.4	
Dry	0.2	-0.3	-1.5	-3.5	-3.2	-2.2	-1.9	-1.4	-0.1	0.1	-0.4	-0.3	
Critical	0.5	0.2	-2.0	-1.6	-2.9	-2.2	-1.2	-0.9	-0.5	-0.3	-0.3	-0.2	

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) X2 is defined as the position of the 2% (grams of salt per kilogram of seawater) bottom salinity value along the axis of the estuary, measured in kilometers from the Golden Gate Bridge. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-16-5. X2, End of Month Position

Second Basis of Comparison

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	92.6	93.1	90.9	87.3	80.8	78.5	78.7	81.5	83.5	86.7	89.9	92.0
20%	91.9	91.4	90.6	85.8	75.6	73.6	75.2	79.5	81.6	84.8	88.6	91.5
30%	91.4	91.0	89.6	83.3	72.0	68.3	73.1	78.5	80.6	84.3	88.0	91.0
40%	91.0	90.8	88.6	78.8	66.2	66.5	69.7	75.3	78.7	82.0	86.6	90.1
50%	90.5	90.3	86.7	75.6	61.4	61.6	67.4	72.9	77.8	80.9	85.3	89.5
60%	90.3	89.6	82.5	67.7	55.7	57.8	64.1	69.2	76.2	79.1	84.7	89.0
70%	90.0	89.1	76.9	56.2	52.4	54.1	59.7	66.0	74.4	78.3	84.5	88.7
80%	89.6	88.0	65.9	52.0	49.3	50.4	54.7	60.2	71.4	77.3	84.0	88.4
90%	88.2	79.6	53.3	49.5	48.3	48.8	50.4	54.6	63.9	74.7	83.0	87.8
Long Term												
Full Simulation Period ^b	90.0	87.6	79.5	70.3	62.9	62.3	65.9	70.6	75.8	80.6	85.9	89.3
Water Year Types ^c												
Wet (32%)	87.8	84.8	75.8	55.7	51.6	53.0	56.4	60.2	67.2	75.2	83.3	86.7
Above Normal (16%)	90.3	87.9	80.5	63.6	56.0	55.2	61.2	67.9	75.1	78.2	83.8	81.9
Below Normal (13%)	89.4	88.6	80.6	78.7	66.4	67.6	71.3	74.9	78.2	81.3	85.9	89.7
Dry (24%)	91.2	87.2	76.9	81.1	70.8	67.5	70.7	75.9	80.2	84.4	88.1	90.9
Critical (15%)	93.1	93.4	89.8	83.6	78.1	76.7	78.8	83.3	85.7	88.2	90.6	92.3

Alternative 3

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	93.2	93.6	90.8	86.1	77.8	75.8	78.2	81.5	83.2	86.4	90.0	92.2
20%	91.9	91.5	90.5	83.7	71.7	72.5	74.6	79.6	82.0	84.8	88.4	91.3
30%	91.6	91.1	89.4	81.5	67.6	66.1	71.3	78.4	81.0	84.3	87.7	90.8
40%	91.2	90.8	88.5	74.8	64.1	64.5	69.7	75.6	80.3	81.7	86.0	89.8
50%	90.7	90.6	86.7	71.8	58.8	60.0	67.3	73.1	78.8	80.7	84.9	89.3
60%	90.2	89.8	82.6	64.6	54.4	58.0	63.6	70.4	77.1	78.4	84.6	88.7
70%	89.9	89.0	74.2	55.1	52.2	54.4	59.9	66.8	75.1	77.8	84.2	88.4
80%	89.6	87.9	65.1	51.2	49.3	50.4	54.8	61.7	71.8	77.1	83.2	88.2
90%	88.2	79.6	53.0	49.5	48.1	48.8	50.4	54.8	64.9	75.0	82.4	87.6
Long Term												
Full Simulation Period ^b	90.1	87.8	79.0	68.5	61.2	61.4	65.5	70.8	76.5	80.5	85.6	89.1
Water Year Types ^c												
Wet (32%)	87.8	84.8	75.3	54.8	51.3	53.1	56.5	60.8	68.3	75.1	82.9	86.6
Above Normal (16%)	90.3	88.0	80.0	61.5	54.9	55.0	60.9	68.4	76.2	78.0	83.4	81.8
Below Normal (13%)	89.2	88.8	80.2	75.4	64.0	66.6	70.5	74.9	79.6	81.0	85.1	89.2
Dry (24%)	91.4	87.4	76.4	78.8	67.9	65.5	69.9	76.0	80.4	84.3	87.8	90.8
Critical (15%)	93.4	93.7	89.3	82.7	75.6	74.6	78.1	82.8	85.4	88.0	90.5	92.3

Alternative 3 minus Second Basis of Comparison

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.5	0.5	-0.1	-1.2	-3.0	-2.7	-0.5	-0.1	-0.3	-0.3	0.1	0.2
20%	0.1	0.1	-0.1	-2.2	-3.9	-1.1	-0.6	0.1	0.4	0.0	-0.2	-0.2
30%	0.2	0.1	-0.1	-1.8	-4.4	-2.1	-1.8	-0.1	0.4	0.0	-0.4	-0.2
40%	0.2	0.0	-0.2	-4.0	-2.0	-2.1	0.0	0.3	1.6	-0.3	-0.5	-0.3
50%	0.2	0.3	0.0	-3.9	-2.6	-1.6	-0.2	0.3	1.0	-0.3	-0.4	-0.2
60%	-0.1	0.1	0.2	-3.1	-1.3	0.2	-0.5	1.2	0.9	-0.7	-0.1	-0.3
70%	-0.1	-0.1	-2.7	-1.1	-0.2	0.2	0.2	0.8	0.7	-0.5	-0.2	-0.2
80%	0.0	-0.1	-0.8	-0.8	0.0	0.1	0.1	1.5	0.3	-0.2	-0.8	-0.2
90%	0.0	0.0	-0.3	0.0	-0.2	0.0	0.0	0.2	1.0	0.2	-0.6	-0.1
Long Term												
Full Simulation Period ^b	0.1	0.1	-0.5	-1.8	-1.7	-1.0	-0.4	0.2	0.7	-0.2	-0.3	-0.2
Water Year Types ^c												
Wet	0.0	0.0	-0.4	-0.9	-0.3	0.1	0.1	0.5	1.1	-0.1	-0.4	-0.1
Above Normal	0.0	0.1	-0.5	-2.1	-1.1	-0.2	-0.2	0.5	1.1	-0.2	-0.4	-0.1
Below Normal	-0.2	0.2	-0.5	-3.4	-2.4	-1.1	-0.8	0.1	1.4	-0.3	-0.7	-0.5
Dry	0.2	0.2	-0.5	-2.4	-2.9	-2.1	-0.8	0.1	0.3	-0.2	-0.2	-0.1
Critical	0.4	0.3	-0.6	-0.9	-2.5	-2.1	-0.7	-0.4	-0.3	-0.2	-0.1	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) X2 is defined as the position of the 2% (grams of salt per kilogram of seawater) bottom salinity value along the axis of the estuary, measured in kilometers from the Golden Gate Bridge. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-16-6. X2, End of Month Position

Second Basis of Comparison		End of Month Position (km)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	92.6	93.1	90.9	87.3	80.8	78.5	78.7	81.5	83.5	86.7	89.9	92.0	
20%	91.9	91.4	90.6	85.8	75.6	73.6	75.2	79.5	81.6	84.8	88.6	91.5	
30%	91.4	91.0	89.6	83.3	72.0	68.3	73.1	78.5	80.6	84.3	88.0	91.0	
40%	91.0	90.8	88.6	78.8	66.2	66.5	69.7	75.3	78.7	82.0	86.6	90.1	
50%	90.5	90.3	86.7	75.6	61.4	61.6	67.4	72.9	77.8	80.9	85.3	89.5	
60%	90.3	89.6	82.5	67.7	55.7	57.8	64.1	69.2	76.2	79.1	84.7	89.0	
70%	90.0	89.1	76.9	56.2	52.4	54.1	59.7	66.0	74.4	78.3	84.5	88.7	
80%	89.6	88.0	65.9	52.0	49.3	50.4	54.7	60.2	71.4	77.3	84.0	88.4	
90%	88.2	79.6	53.3	49.5	48.3	48.8	50.4	54.6	63.9	74.7	83.0	87.8	
Long Term													
Full Simulation Period ^b	90.0	87.6	79.5	70.3	62.9	62.3	65.9	70.6	75.8	80.6	85.9	89.3	
Water Year Types^c													
Wet (32%)	87.8	84.8	75.8	55.7	51.6	53.0	56.4	60.2	67.2	75.2	83.3	86.7	
Above Normal (16%)	90.3	87.9	80.5	63.6	56.0	55.2	61.2	67.9	75.1	78.2	83.8	81.9	
Below Normal (13%)	89.4	88.6	80.6	78.7	66.4	67.6	71.3	74.9	78.2	81.3	85.9	89.7	
Dry (24%)	91.2	87.2	76.9	81.1	70.8	67.5	70.7	75.9	80.2	84.4	88.1	90.9	
Critical (15%)	93.1	93.4	89.8	83.6	78.1	76.7	78.8	83.3	85.7	88.2	90.6	92.3	

Alternative 5		End of Month Position (km)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	93.2	93.3	90.8	84.0	77.3	75.9	77.2	79.1	83.1	86.5	89.6	91.9	
20%	91.9	91.5	87.6	82.3	71.7	72.8	72.5	77.9	81.4	84.9	88.1	91.1	
30%	91.6	91.0	83.9	79.8	67.2	65.8	69.5	75.8	81.0	84.2	87.4	90.5	
40%	91.0	88.0	82.4	73.5	63.9	64.5	66.4	71.5	79.6	82.3	86.1	90.0	
50%	89.5	81.1	81.2	71.2	58.5	59.9	64.2	69.3	77.8	80.7	84.8	88.5	
60%	81.0	81.0	79.7	64.4	55.1	57.9	60.8	66.4	76.6	78.2	84.6	81.0	
70%	74.1	75.1	71.9	55.1	51.9	53.9	58.0	63.7	73.4	77.5	84.1	74.1	
80%	74.0	74.1	62.2	51.3	49.4	50.6	53.5	58.9	69.8	76.8	82.6	74.0	
90%	74.0	73.9	53.0	49.4	48.2	49.1	49.9	53.3	63.5	74.6	82.2	74.0	
Long Term													
Full Simulation Period ^b	84.2	82.3	76.4	68.0	61.1	61.4	63.8	68.2	75.7	80.4	85.3	83.8	
Water Year Types^c													
Wet (32%)	73.9	72.9	71.1	54.7	51.2	53.1	55.1	58.2	67.3	74.7	82.6	73.9	
Above Normal (16%)	81.0	79.2	75.9	60.9	54.9	55.3	59.0	65.0	75.2	77.9	83.1	74.8	
Below Normal (13%)	89.1	87.2	78.6	74.6	64.3	66.9	68.4	72.1	79.0	81.1	85.0	89.3	
Dry (24%)	91.4	87.0	75.4	77.7	67.7	65.4	67.9	73.4	79.8	84.5	87.6	90.5	
Critical (15%)	93.5	93.5	87.9	82.1	75.5	74.6	76.7	80.8	84.5	87.7	90.2	92.1	

Alternative 5 minus Second Basis of Comparison		End of Month Position (km)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	0.6	0.2	-0.1	-3.2	-3.5	-2.6	-1.5	-2.4	-0.4	-0.2	-0.3	-0.1	
20%	0.0	0.1	-3.0	-3.6	-3.9	-0.8	-2.7	-1.6	-0.2	0.1	-0.4	-0.4	
30%	0.2	0.0	-5.6	-3.5	-4.8	-2.5	-3.6	-2.7	0.4	-0.1	-0.6	-0.5	
40%	0.0	-2.8	-6.3	-5.3	-2.2	-2.0	-3.2	-3.8	0.9	0.3	-0.5	-0.1	
50%	-1.0	-9.2	-5.6	-4.4	-3.0	-1.7	-3.2	-3.5	0.0	-0.2	-0.5	-1.1	
60%	-9.3	-8.7	-2.7	-3.3	-0.6	0.1	-3.4	-2.8	0.3	-0.9	-0.1	-8.0	
70%	-16.0	-14.0	-5.1	-1.1	-0.5	-0.2	-1.7	-2.3	-1.0	-0.8	-0.4	-14.6	
80%	-15.6	-13.9	-3.6	-0.8	0.1	0.2	-1.2	-1.3	-1.6	-0.5	-1.4	-14.4	
90%	-14.2	-5.6	-0.3	-0.1	-0.1	0.3	-0.5	-1.2	-0.4	-0.1	-0.8	-13.8	
Long Term													
Full Simulation Period ^b	-5.8	-5.4	-3.1	-2.3	-1.7	-0.9	-2.1	-2.4	-0.1	-0.3	-0.6	-5.4	
Water Year Types^c													
Wet	-13.9	-11.9	-4.7	-1.0	-0.4	0.0	-1.3	-2.0	0.1	-0.5	-0.6	-12.7	
Above Normal	-9.3	-8.6	-4.5	-2.6	-1.1	0.0	-2.1	-2.9	0.1	-0.3	-0.7	-7.1	
Below Normal	-0.3	-1.4	-2.0	-4.2	-2.1	-0.7	-2.9	-2.8	0.8	-0.2	-0.9	-0.4	
Dry	0.2	-0.2	-1.5	-3.4	-3.1	-2.1	-2.8	-2.5	-0.3	0.1	-0.5	-0.4	
Critical	0.4	0.1	-2.0	-1.5	-2.7	-2.1	-2.1	-2.5	-1.2	-0.5	-0.4	-0.2	

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) X2 is defined as the position of the 2% (grams of salt per kilogram of seawater) bottom salinity value along the axis of the estuary, measured in kilometers from the Golden Gate Bridge. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1 **C.17. Old and Middle River Flow**


Figure C-17-1. Old and Middle River, Long-Term* Average Flow

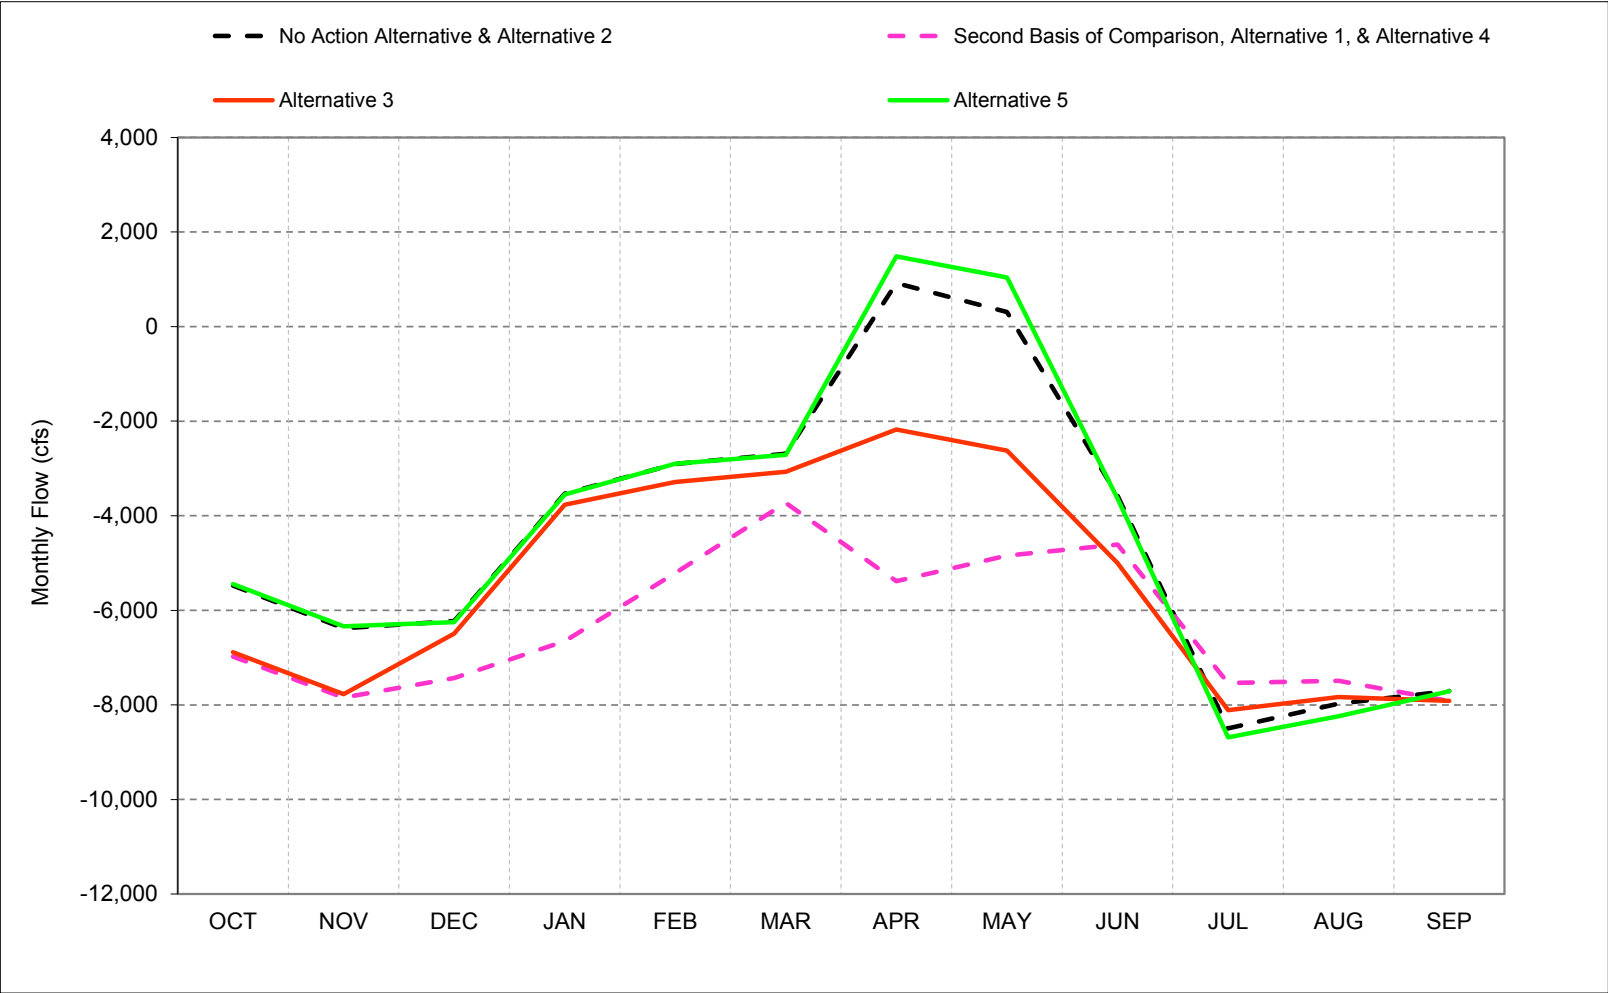

*Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-17-2. Old and Middle River, Wet Year* Long-Term** Average Flow

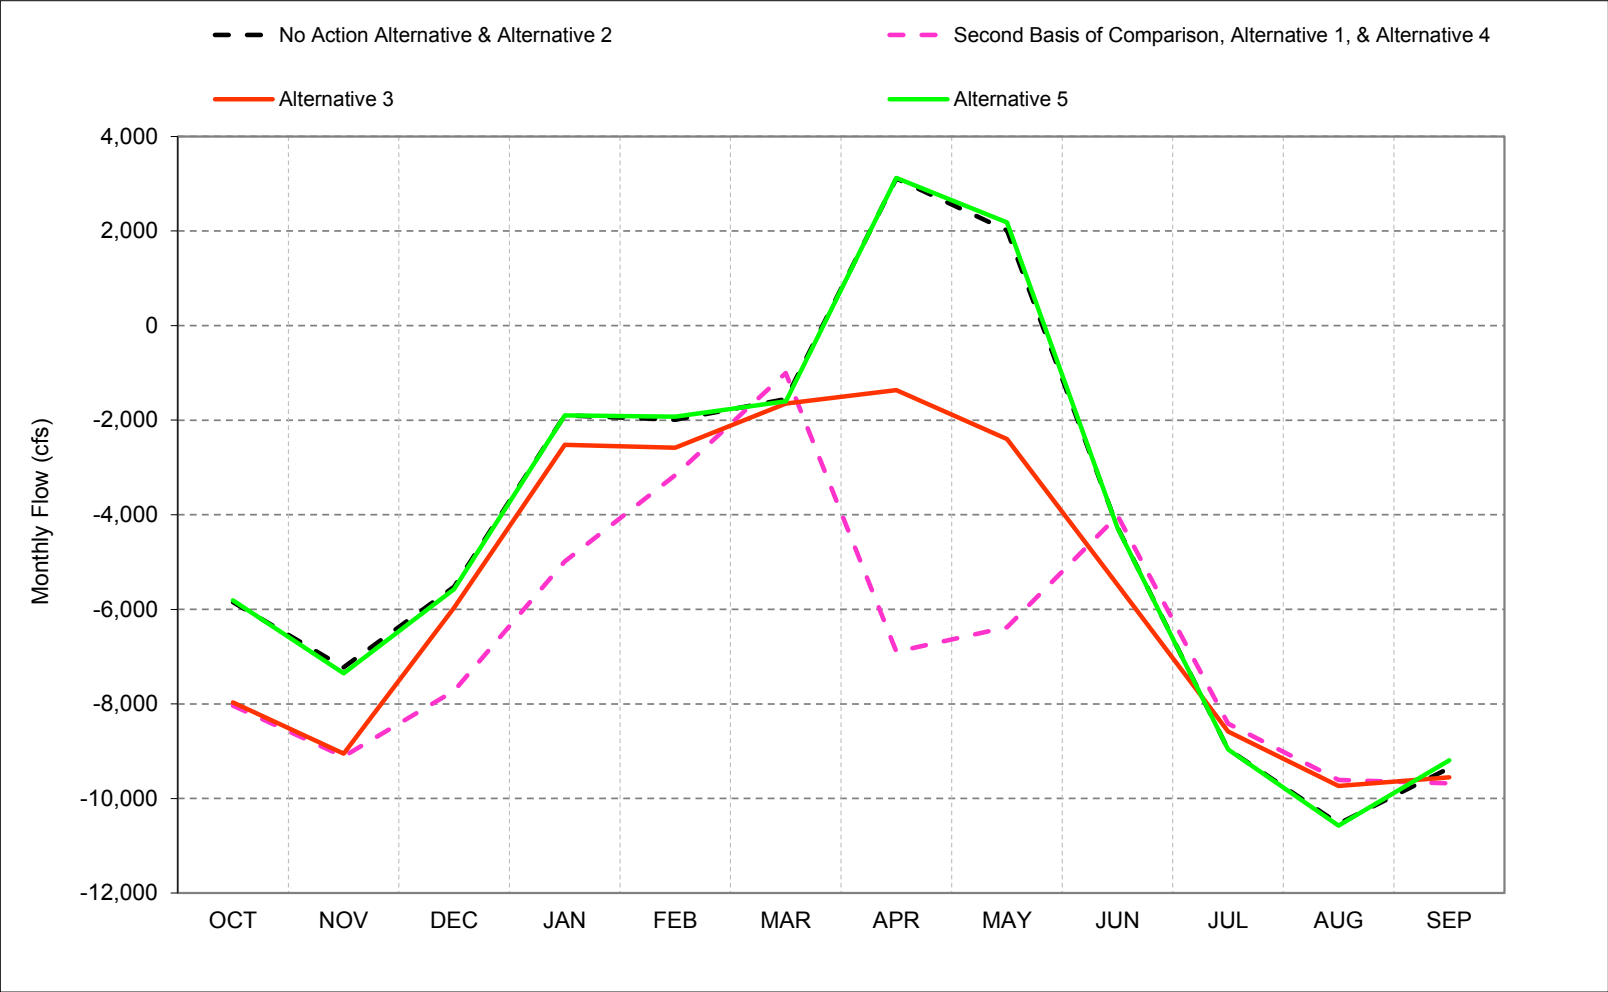


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-17-3. Old and Middle River, Above Normal Year* Long-Term** Average Flow

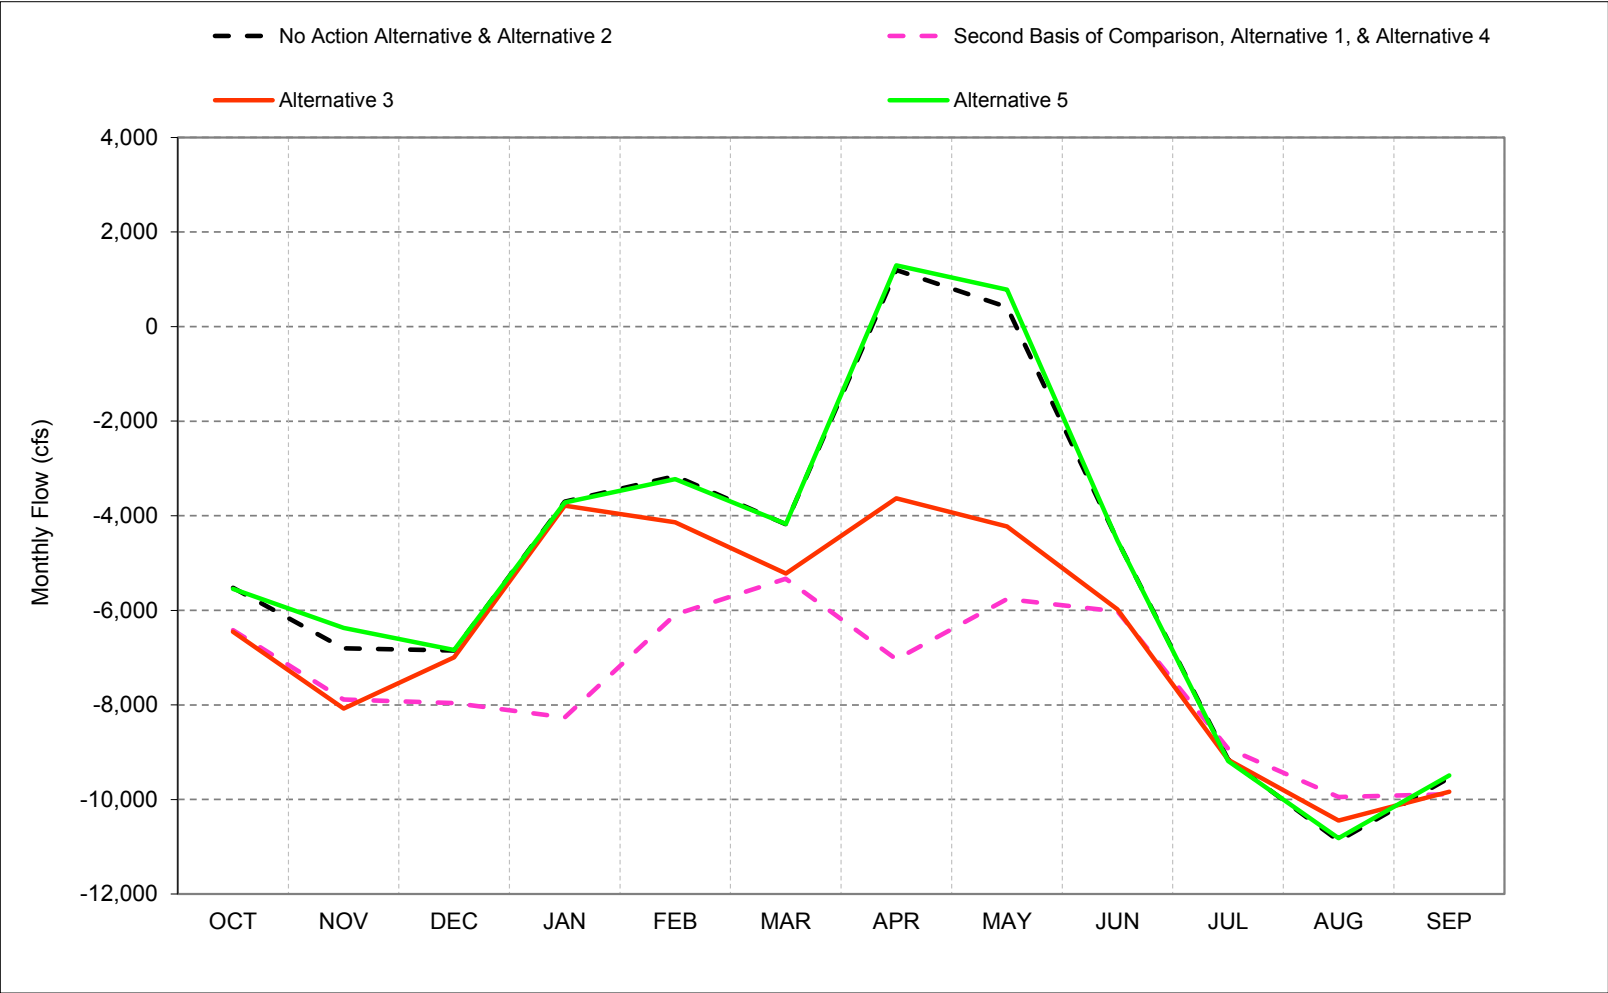


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-17-4. Old and Middle River, Below Normal Year* Long-Term** Average Flow

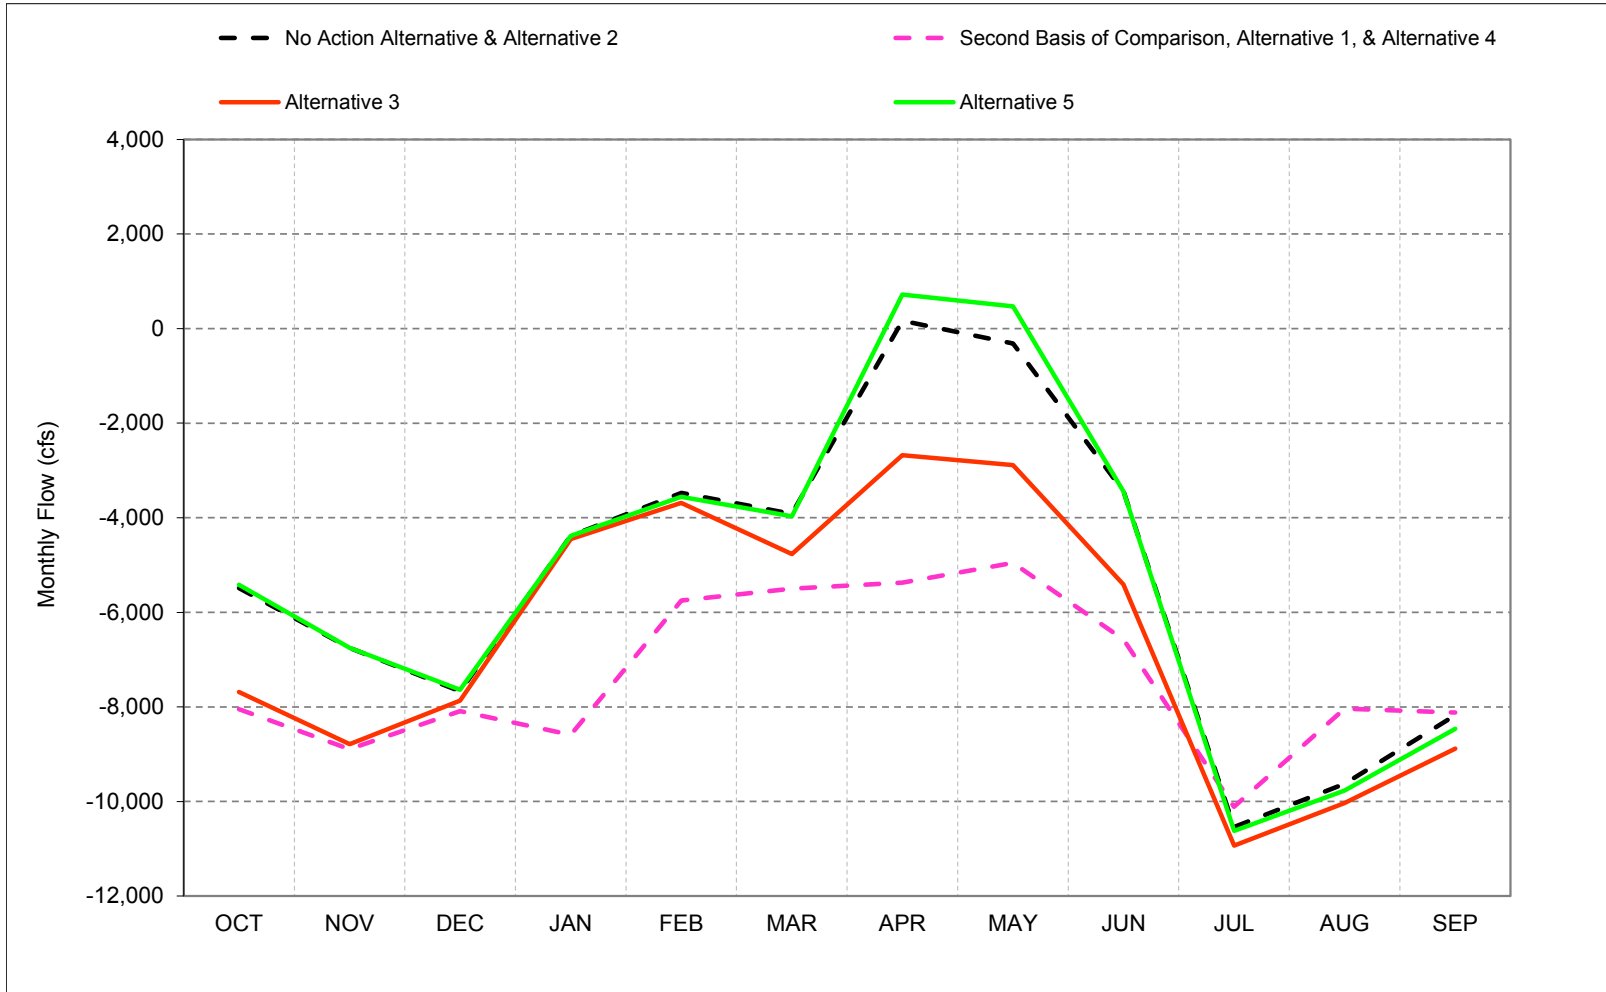


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-17-5. Old and Middle River, Dry Year* Long-Term** Average Flow

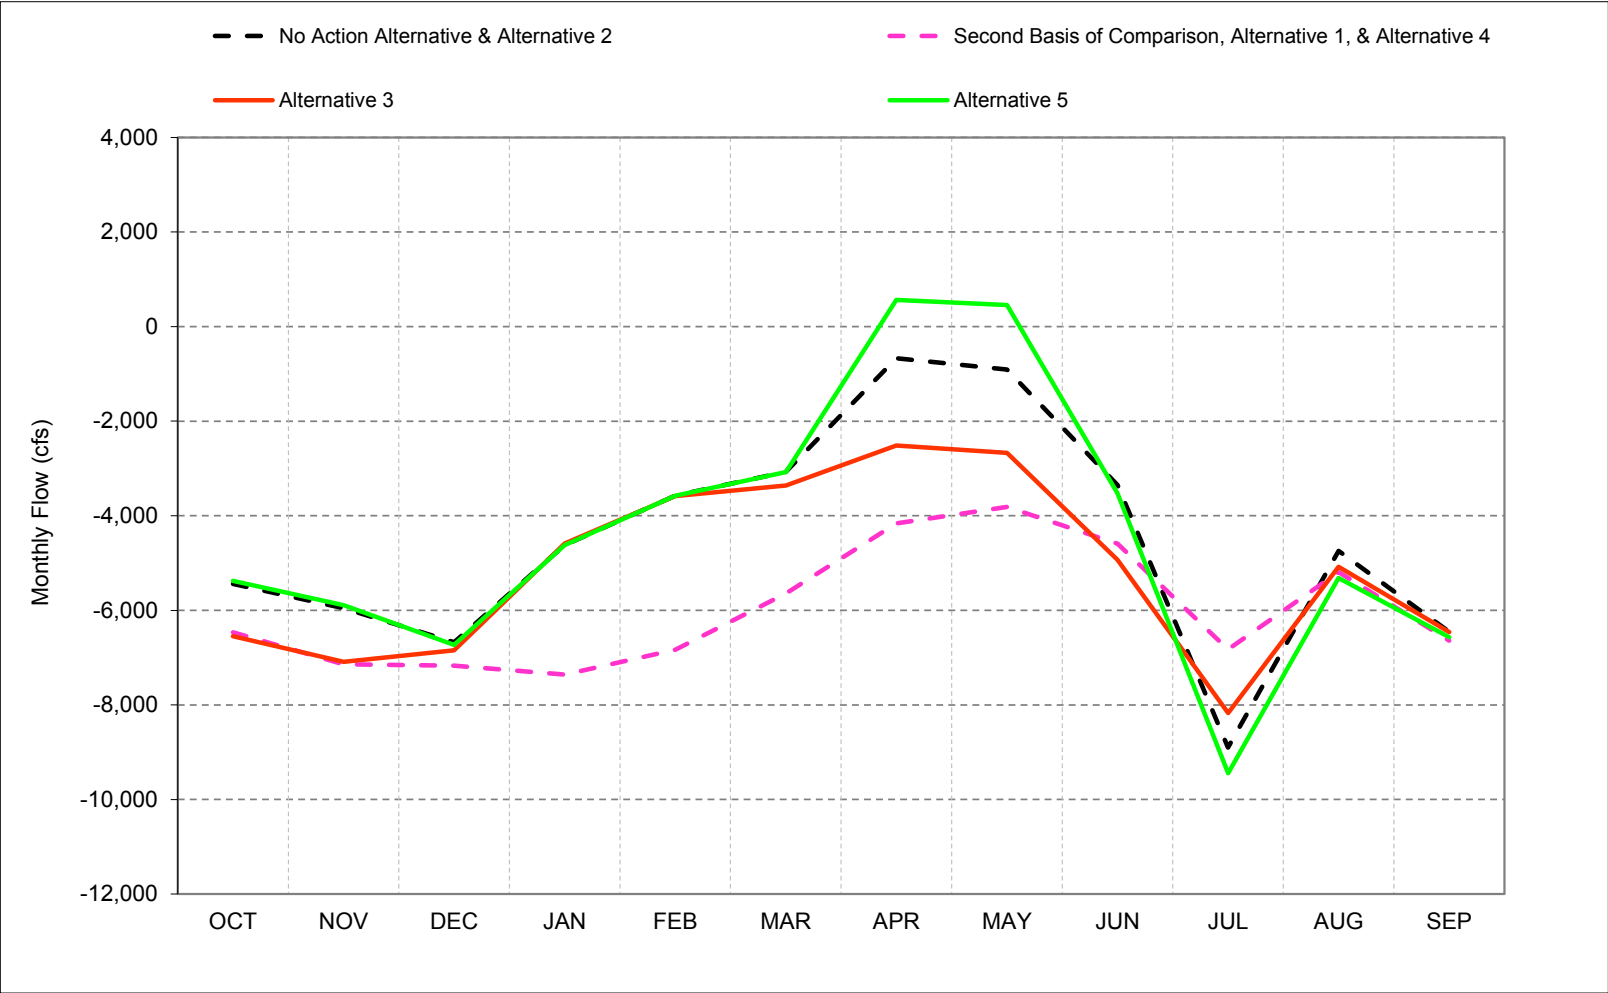


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-17-6. Old and Middle River, Critical Year* Long-Term** Average Flow

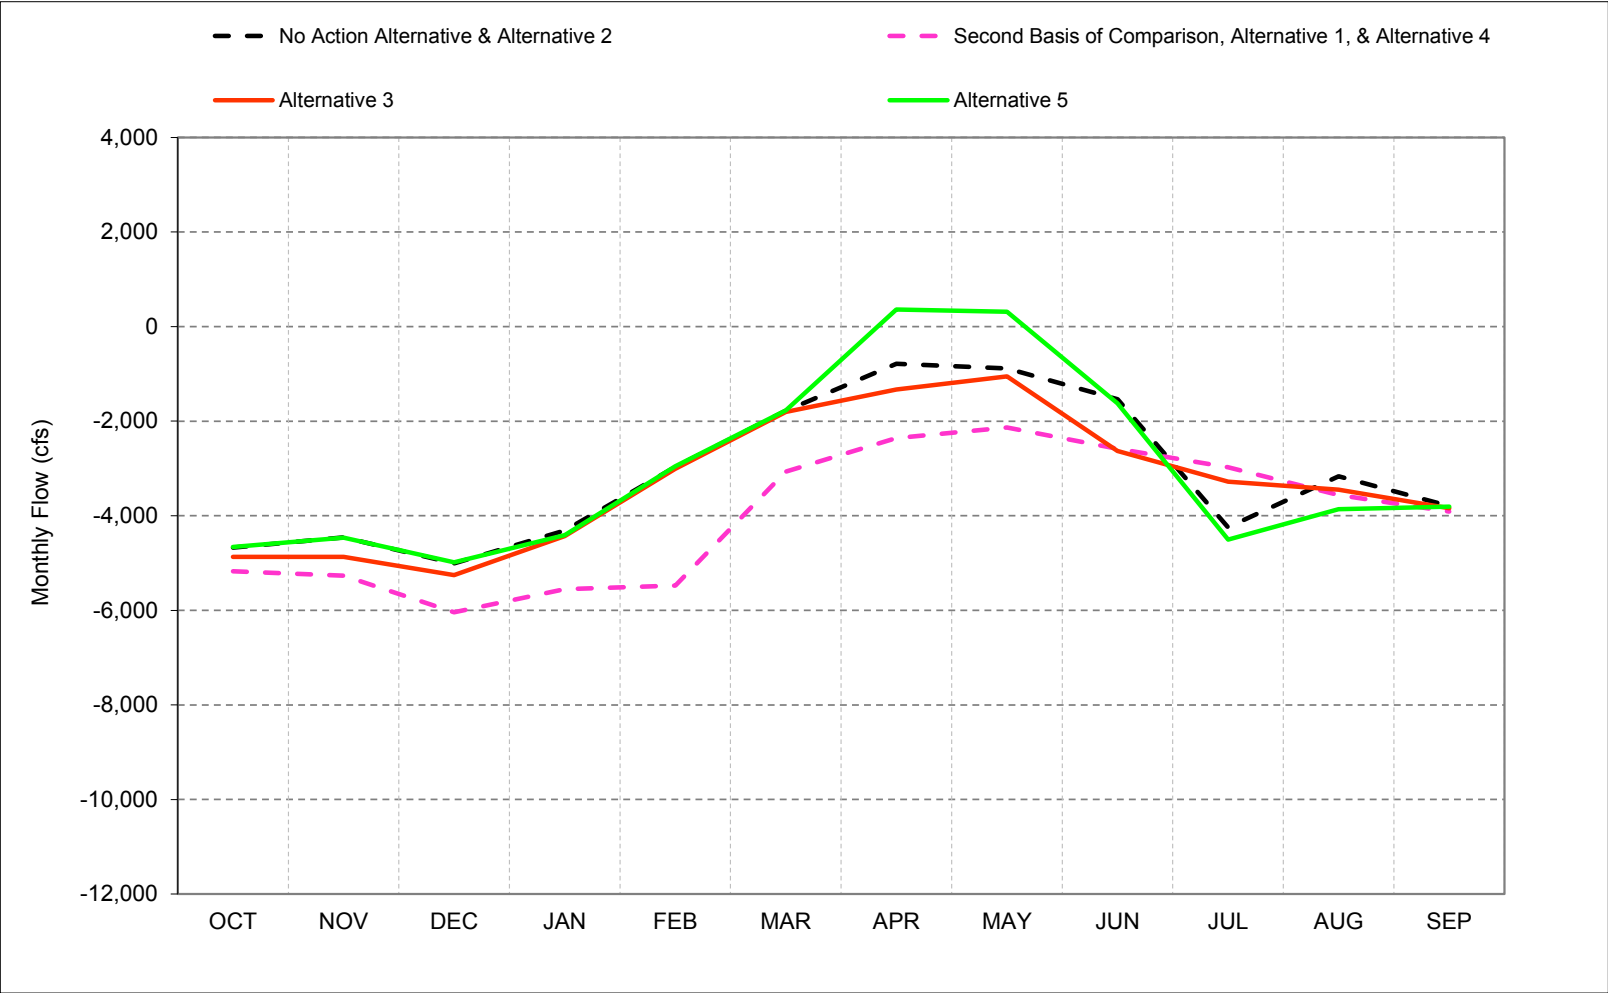

*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-17-1. Old and Middle River, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-3,764	-3,724	-3,812	-2,823	-666	-969	3,205	2,797	-1,150	-4,130	-2,453	-3,775
20%	-4,076	-4,560	-4,673	-2,823	-1,771	-1,394	2,207	1,304	-1,570	-6,849	-4,032	-5,147
30%	-4,613	-5,156	-5,244	-3,355	-2,823	-2,738	1,632	561	-3,500	-7,647	-5,770	-6,006
40%	-4,820	-5,627	-5,871	-4,392	-3,314	-3,500	1,268	108	-3,500	-8,888	-7,996	-7,621
50%	-5,328	-6,320	-5,871	-4,710	-3,781	-3,500	612	-182	-3,500	-9,376	-9,956	-9,000
60%	-5,589	-6,564	-5,871	-5,000	-4,878	-4,568	-102	-483	-4,487	-9,746	-10,630	-9,256
70%	-6,253	-7,101	-7,413	-5,000	-5,000	-5,000	-448	-632	-5,000	-10,301	-10,737	-9,653
80%	-6,560	-8,185	-9,537	-5,000	-5,000	-5,000	-995	-1,129	-5,000	-10,602	-10,853	-9,884
90%	-7,404	-9,995	-9,681	-5,000	-5,000	-5,000	-1,247	-1,414	-5,000	-11,108	-11,083	-10,032
Long Term												
Full Simulation Period ^b	-5,476	-6,380	-6,228	-3,535	-2,905	-2,690	919	310	-3,577	-8,496	-7,975	-7,706
Water Year Types^c												
Wet (32%)	-5,847	-7,229	-5,526	-1,900	-1,991	-1,552	3,110	2,011	-4,274	-8,957	-10,532	-9,358
Above Normal (16%)	-5,525	-6,801	-6,850	-3,699	-3,161	-4,176	1,196	412	-4,525	-9,151	-10,873	-9,542
Below Normal (13%)	-5,488	-6,749	-7,669	-4,380	-3,477	-3,919	165	-316	-3,445	-10,539	-9,624	-8,178
Dry (24%)	-5,440	-5,953	-6,676	-4,621	-3,573	-3,072	-670	-906	-3,350	-8,900	-4,745	-6,453
Critical (15%)	-4,671	-4,458	-5,006	-4,314	-2,968	-1,780	-786	-887	-1,539	-4,242	-3,168	-3,793

Alternative 1												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-3,392	-4,293	-4,109	-2,581	-1,241	-119	-2,051	-1,611	-2,184	-3,454	-2,880	-3,666
20%	-4,079	-5,433	-6,043	-4,838	-2,865	-1,287	-3,131	-2,897	-2,834	-5,152	-4,631	-5,107
30%	-4,769	-6,994	-6,917	-6,279	-4,367	-3,292	-3,957	-4,177	-3,308	-6,488	-5,837	-6,393
40%	-6,409	-7,620	-7,554	-7,434	-5,806	-4,012	-4,821	-4,673	-4,258	-7,155	-6,876	-8,264
50%	-7,303	-8,686	-8,173	-8,257	-6,422	-4,958	-5,864	-5,200	-4,990	-8,014	-7,941	-9,257
60%	-8,076	-9,256	-8,969	-8,848	-7,346	-5,373	-6,549	-5,517	-5,660	-8,914	-9,236	-9,689
70%	-9,075	-9,598	-9,326	-9,269	-8,323	-6,205	-7,131	-6,008	-6,016	-9,492	-10,081	-9,977
80%	-9,905	-9,959	-9,508	-9,585	-8,873	-6,616	-7,635	-6,451	-6,534	-10,052	-10,364	-10,089
90%	-10,146	-10,023	-9,665	-9,803	-9,509	-7,592	-7,991	-7,302	-6,936	-10,637	-10,683	-10,163
Long Term												
Full Simulation Period ^b	-6,980	-7,844	-7,429	-6,650	-5,206	-3,727	-5,381	-4,842	-4,611	-7,538	-7,489	-7,917
Water Year Types^c												
Wet (32%)	-8,038	-9,112	-7,723	-4,985	-3,160	-1,004	-6,895	-6,376	-4,024	-8,414	-9,609	-9,678
Above Normal (16%)	-6,419	-7,887	-7,960	-8,266	-6,089	-5,331	-7,034	-5,761	-6,024	-8,921	-9,947	-9,886
Below Normal (13%)	-8,051	-8,891	-8,088	-8,590	-5,749	-5,501	-5,370	-4,954	-6,578	-10,111	-8,035	-8,118
Dry (24%)	-6,466	-7,140	-7,171	-7,358	-6,832	-5,646	-4,159	-3,813	-4,591	-6,827	-5,191	-6,639
Critical (15%)	-5,171	-5,266	-6,040	-5,551	-5,474	-3,067	-2,358	-2,134	-2,583	-2,973	-3,561	-3,911

Alternative 1 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	373	-569	-298	241	-575	850	-5,257	-4,408	-1,033	675	-426	109
20%	-3	-873	-1,370	-2,015	-1,094	107	-5,338	-4,202	-1,264	1,697	-599	39
30%	-156	-1,838	-1,673	-2,924	-1,545	-554	-5,589	-4,738	192	1,159	-67	-387
40%	-1,588	-1,993	-1,683	-3,042	-2,492	-512	-6,090	-4,781	-758	1,733	1,120	-644
50%	-1,975	-2,366	-2,302	-3,548	-2,641	-1,458	-6,475	-5,018	-1,490	1,362	2,016	-257
60%	-2,487	-2,692	-3,098	-3,848	-2,467	-806	-6,447	-5,034	-1,173	831	1,394	-433
70%	-2,822	-2,497	-1,913	-4,269	-3,323	-1,205	-6,682	-5,376	-1,016	809	656	-325
80%	-3,345	-1,773	29	-4,585	-3,873	-1,616	-6,640	-5,322	-1,534	550	489	-205
90%	-2,742	-28	16	-4,803	-4,509	-2,592	-6,744	-5,887	-1,936	471	400	-132
Long Term												
Full Simulation Period ^b	-1,504	-1,464	-1,201	-3,115	-2,301	-1,037	-6,300	-5,152	-1,034	958	486	-211
Water Year Types^c												
Wet (32%)	-2,191	-1,882	-2,198	-3,084	-1,169	549	-10,005	-8,387	250	543	923	-320
Above Normal (16%)	-895	-1,086	-1,110	-4,566	-2,928	-1,155	-8,229	-6,173	-1,499	230	926	-344
Below Normal (13%)	-2,563	-2,142	-419	-4,210	-2,273	-1,582	-5,535	-4,638	-3,133	429	1,589	59
Dry (24%)	-1,026	-1,187	-495	-2,737	-3,259	-2,574	-3,489	-2,907	-1,241	2,073	-446	-186
Critical (15%)	-500	-809	-1,034	-1,237	-2,505	-1,287	-1,572	-1,247	-1,044	1,268	-394	-118

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-17-2. Old and Middle River, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-3,764	-3,724	-3,812	-2,823	-666	-969	3,205	2,797	-1,150	-4,130	-2,453	-3,775
20%	-4,076	-4,560	-4,673	-2,823	-1,771	-1,394	2,207	1,304	-1,570	-6,849	-4,032	-5,147
30%	-4,613	-5,156	-5,244	-3,355	-2,823	-2,738	1,632	561	-3,500	-7,647	-5,770	-6,006
40%	-4,820	-5,627	-5,871	-4,392	-3,314	-3,500	1,268	108	-3,500	-8,888	-7,996	-7,621
50%	-5,328	-6,320	-5,871	-4,710	-3,781	-3,500	612	-182	-3,500	-9,376	-9,956	-9,000
60%	-5,589	-6,564	-5,871	-5,000	-4,878	-4,568	-102	-483	-4,487	-9,746	-10,630	-9,256
70%	-6,253	-7,101	-7,413	-5,000	-5,000	-5,000	-448	-632	-5,000	-10,301	-10,737	-9,653
80%	-6,560	-8,185	-9,537	-5,000	-5,000	-5,000	-995	-1,129	-5,000	-10,602	-10,853	-9,884
90%	-7,404	-9,995	-9,681	-5,000	-5,000	-5,000	-1,247	-1,414	-5,000	-11,108	-11,083	-10,032
Long Term												
Full Simulation Period ^b	-5,476	-6,380	-6,228	-3,535	-2,905	-2,690	919	310	-3,577	-8,496	-7,975	-7,706
Water Year Types^c												
Wet (32%)	-5,847	-7,229	-5,526	-1,900	-1,991	-1,552	3,110	2,011	-4,274	-8,957	-10,532	-9,358
Above Normal (16%)	-5,525	-6,801	-6,850	-3,699	-3,161	-4,176	1,196	412	-4,525	-9,151	-10,873	-9,542
Below Normal (13%)	-5,488	-6,749	-7,669	-4,380	-3,477	-3,919	165	-316	-3,445	-10,539	-9,624	-8,178
Dry (24%)	-5,440	-5,953	-6,676	-4,621	-3,573	-3,072	-670	-906	-3,350	-8,900	-4,745	-6,453
Critical (15%)	-4,671	-4,458	-5,006	-4,314	-2,968	-1,780	-786	-887	-1,539	-4,242	-3,168	-3,793

Alternative 3												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-3,471	-4,154	-3,935	-2,361	-447	-819	405	-673	-2,098	-3,660	-3,007	-3,495
20%	-4,101	-5,233	-5,184	-3,500	-1,896	-1,347	-946	-1,150	-4,287	-5,775	-4,278	-5,225
30%	-4,803	-6,947	-6,403	-3,500	-2,838	-2,283	-1,200	-1,150	-4,625	-7,093	-6,258	-6,437
40%	-5,638	-7,541	-6,403	-3,500	-3,500	-3,500	-2,086	-2,569	-5,017	-8,012	-7,669	-8,402
50%	-7,049	-8,326	-6,403	-5,000	-3,500	-3,500	-2,787	-3,326	-5,526	-8,990	-9,396	-9,192
60%	-8,252	-9,400	-6,811	-5,000	-4,273	-3,616	-3,368	-3,500	-5,750	-9,549	-9,845	-9,680
70%	-8,982	-9,810	-7,677	-5,000	-5,000	-5,061	-3,526	-3,500	-5,750	-10,046	-10,212	-9,842
80%	-9,734	-9,990	-8,823	-5,000	-5,621	-6,252	-4,031	-4,451	-6,160	-10,767	-10,624	-10,044
90%	-10,085	-10,084	-9,552	-6,976	-7,500	-7,499	-4,474	-5,149	-7,011	-11,148	-10,797	-10,177
Long Term												
Full Simulation Period ^b	-6,888	-7,771	-6,494	-3,764	-3,283	-3,072	-2,176	-2,623	-4,997	-8,112	-7,831	-7,917
Water Year Types^c												
Wet (32%)	-7,965	-9,052	-5,964	-2,522	-2,581	-1,646	-1,367	-2,399	-5,476	-8,581	-9,731	-9,555
Above Normal (16%)	-6,452	-8,078	-6,997	-3,789	-4,137	-5,220	-3,630	-4,226	-5,981	-9,160	-10,444	-9,839
Below Normal (13%)	-7,685	-8,790	-7,868	-4,451	-3,689	-4,765	-2,676	-2,885	-5,409	-10,929	-10,032	-8,880
Dry (24%)	-6,546	-7,086	-6,848	-4,588	-3,582	-3,358	-2,517	-2,679	-4,927	-8,172	-5,079	-6,457
Critical (15%)	-4,869	-4,871	-5,252	-4,429	-3,011	-1,804	-1,328	-1,054	-2,628	-3,280	-3,450	-3,839

Alternative 3 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	293	-431	-123	462	219	149	-2,801	-3,470	-948	470	-554	280
20%	-24	-673	-512	-677	-125	46	-3,153	-2,455	-2,717	1,074	-246	-79
30%	-190	-1,791	-1,159	-145	-16	455	-2,832	-1,711	-1,125	554	-488	-431
40%	-817	-1,914	-532	892	-186	0	-3,354	-2,668	-1,517	876	326	-781
50%	-1,721	-2,006	-532	-290	281	0	-3,399	-3,144	-2,026	386	560	-193
60%	-2,663	-2,836	-940	0	605	951	-3,266	-3,017	-1,263	196	785	-423
70%	-2,729	-2,709	-265	0	0	-61	-3,078	-2,868	-750	256	525	-189
80%	-3,174	-1,805	713	0	-621	-1,252	-3,036	-3,323	-1,160	-165	230	-160
90%	-2,681	-89	129	-1,976	-2,500	-2,499	-3,227	-3,735	-2,011	-39	286	-146
Long Term												
Full Simulation Period ^b	-1,412	-1,391	-267	-230	-379	-382	-3,095	-2,933	-1,420	384	144	-211
Water Year Types^c												
Wet (32%)	-2,119	-1,823	-438	-622	-590	-93	-4,477	-4,410	-1,202	376	800	-197
Above Normal (16%)	-927	-1,277	-147	-89	-975	-1,044	-4,826	-4,637	-1,456	-10	429	-297
Below Normal (13%)	-2,197	-2,041	-199	-71	-212	-846	-2,841	-2,569	-1,964	-389	-408	-703
Dry (24%)	-1,106	-1,133	-172	33	-9	-286	-1,847	-1,764	-1,577	728	-334	-4
Critical (15%)	-198	-414	-246	-115	-43	-24	-541	-167	-1,089	962	-282	-46

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-17-3. Old and Middle River, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-3,764	-3,724	-3,812	-2,823	-666	-969	3,205	2,797	-1,150	-4,130	-2,453	-3,775
20%	-4,076	-4,560	-4,673	-2,823	-1,771	-1,394	2,207	1,304	-1,570	-6,849	-4,032	-5,147
30%	-4,613	-5,156	-5,244	-3,355	-2,823	-2,738	1,632	561	-3,500	-7,647	-5,770	-6,006
40%	-4,820	-5,627	-5,871	-4,392	-3,314	-3,500	1,268	108	-3,500	-8,888	-7,996	-7,621
50%	-5,328	-6,320	-5,871	-4,710	-3,781	-3,500	612	-182	-3,500	-9,376	-9,956	-9,000
60%	-5,589	-6,564	-5,871	-5,000	-4,878	-4,568	-102	-483	-4,487	-9,746	-10,630	-9,256
70%	-6,253	-7,101	-7,413	-5,000	-5,000	-5,000	-448	-632	-5,000	-10,301	-10,737	-9,653
80%	-6,560	-8,185	-9,537	-5,000	-5,000	-5,000	-995	-1,129	-5,000	-10,602	-10,853	-9,884
90%	-7,404	-9,995	-9,681	-5,000	-5,000	-5,000	-1,247	-1,414	-5,000	-11,108	-11,083	-10,032
Long Term												
Full Simulation Period ^b	-5,476	-6,380	-6,228	-3,535	-2,905	-2,690	919	310	-3,577	-8,496	-7,975	-7,706
Water Year Types^c												
Wet (32%)	-5,847	-7,229	-5,526	-1,900	-1,991	-1,552	3,110	2,011	-4,274	-8,957	-10,532	-9,358
Above Normal (16%)	-5,525	-6,801	-6,850	-3,699	-3,161	-4,176	1,196	412	-4,525	-9,151	-10,873	-9,542
Below Normal (13%)	-5,488	-6,749	-7,669	-4,380	-3,477	-3,919	165	-316	-3,445	-10,539	-9,624	-8,178
Dry (24%)	-5,440	-5,953	-6,676	-4,621	-3,573	-3,072	-670	-906	-3,350	-8,900	-4,745	-6,453
Critical (15%)	-4,671	-4,458	-5,006	-4,314	-2,968	-1,780	-786	-887	-1,539	-4,242	-3,168	-3,793

Alternative 5												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-3,722	-3,722	-3,826	-2,823	-641	-965	3,206	2,797	-1,150	-4,455	-3,295	-3,913
20%	-4,102	-4,558	-4,737	-2,823	-1,771	-1,394	2,134	1,335	-2,319	-6,620	-4,451	-5,247
30%	-4,583	-5,162	-5,150	-3,355	-2,820	-2,738	1,566	712	-3,500	-8,001	-6,361	-6,304
40%	-4,858	-5,603	-5,871	-4,378	-3,267	-3,500	1,270	568	-3,500	-9,172	-8,612	-7,552
50%	-5,145	-6,098	-5,871	-4,710	-3,513	-3,500	623	381	-3,500	-9,522	-10,244	-8,864
60%	-5,368	-6,494	-5,871	-5,000	-4,878	-4,568	381	381	-4,467	-9,822	-10,615	-9,232
70%	-6,237	-7,087	-7,453	-5,000	-5,000	-5,000	381	381	-5,000	-10,430	-10,756	-9,654
80%	-6,583	-8,086	-9,466	-5,000	-5,000	-5,000	381	381	-5,000	-10,694	-10,844	-9,915
90%	-7,355	-9,871	-9,681	-5,000	-5,000	-5,000	381	381	-5,000	-11,168	-11,076	-10,031
Long Term												
Full Simulation Period ^b	-5,443	-6,337	-6,246	-3,551	-2,904	-2,710	1,482	1,034	-3,631	-8,687	-8,239	-7,714
Water Year Types^c												
Wet (32%)	-5,812	-7,354	-5,572	-1,900	-1,926	-1,598	3,122	2,182	-4,275	-8,965	-10,573	-9,193
Above Normal (16%)	-5,543	-6,368	-6,838	-3,716	-3,222	-4,174	1,292	780	-4,521	-9,187	-10,817	-9,491
Below Normal (13%)	-5,418	-6,748	-7,637	-4,380	-3,554	-3,971	718	468	-3,444	-10,623	-9,770	-8,460
Dry (24%)	-5,380	-5,893	-6,731	-4,620	-3,578	-3,074	565	453	-3,523	-9,446	-5,313	-6,571
Critical (15%)	-4,661	-4,461	-4,983	-4,409	-2,957	-1,770	363	310	-1,623	-4,501	-3,860	-3,805

Alternative 5 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	42	2	-14	0	25	4	0	0	0	-325	-841	-138
20%	-26	2	-64	0	0	0	-73	31	-748	229	-419	-101
30%	29	-6	94	0	3	0	-67	152	0	-355	-591	-299
40%	-37	23	0	14	46	0	2	460	0	-284	-617	68
50%	183	222	0	0	268	0	11	563	0	-145	-287	136
60%	221	70	0	0	0	0	483	864	19	-76	15	25
70%	16	14	-40	0	0	0	830	1,014	0	-128	-19	-1
80%	-23	99	71	0	0	0	1,376	1,510	0	-92	10	-31
90%	49	124	0	0	0	0	1,629	1,796	0	-60	7	1
Long Term												
Full Simulation Period ^b	34	43	-19	-16	1	-20	563	725	-54	-191	-263	-8
Water Year Types^c												
Wet (32%)	35	-124	-46	0	65	-46	12	171	-1	-9	-41	165
Above Normal (16%)	-19	433	12	-16	-61	2	96	368	4	-36	56	51
Below Normal (13%)	70	1	32	0	-77	-53	552	785	1	-84	-145	-283
Dry (24%)	60	60	-56	1	-5	-1	1,235	1,359	-173	-546	-568	-118
Critical (15%)	10	-4	23	-95	11	10	1,150	1,197	-84	-260	-692	-11

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-17-4. Old and Middle River, Monthly Flow

Second Basis of Comparison		Monthly Flow (cfs)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-3,392	-4,293	-4,109	-2,581	-1,241	-119	-2,051	-1,611	-2,184	-3,454	-2,880	-3,666
20%	-4,079	-5,433	-6,043	-4,838	-2,865	-1,287	-3,131	-2,897	-2,834	-5,152	-4,631	-5,107
30%	-4,769	-6,994	-6,917	-6,279	-4,367	-3,292	-3,957	-4,177	-3,308	-6,488	-5,837	-6,393
40%	-6,409	-7,620	-7,554	-7,434	-5,806	-4,012	-4,821	-4,673	-4,258	-7,155	-6,876	-8,264
50%	-7,303	-8,686	-8,173	-8,257	-6,422	-4,958	-5,864	-5,200	-4,990	-8,014	-7,941	-9,257
60%	-8,076	-9,256	-8,969	-8,848	-7,346	-5,373	-6,549	-5,517	-5,660	-8,914	-9,236	-9,689
70%	-9,075	-9,598	-9,326	-9,269	-8,323	-6,205	-7,131	-6,008	-6,016	-9,492	-10,081	-9,977
80%	-9,905	-9,959	-9,508	-9,585	-8,873	-6,616	-7,635	-6,451	-6,534	-10,052	-10,364	-10,089
90%	-10,146	-10,023	-9,665	-9,803	-9,509	-7,592	-7,991	-7,302	-6,936	-10,637	-10,683	-10,163
Long Term												
Full Simulation Period ^b	-6,980	-7,844	-7,429	-6,650	-5,206	-3,727	-5,381	-4,842	-4,611	-7,538	-7,489	-7,917
Water Year Types^c												
Wet (32%)	-8,038	-9,112	-7,723	-4,985	-3,160	-1,004	-6,895	-6,376	-4,024	-8,414	-9,609	-9,678
Above Normal (16%)	-6,419	-7,887	-7,960	-8,266	-6,089	-5,331	-7,034	-5,761	-6,024	-8,921	-9,947	-9,886
Below Normal (13%)	-8,051	-8,891	-8,088	-8,590	-5,749	-5,501	-5,370	-4,954	-6,578	-10,111	-8,035	-8,118
Dry (24%)	-6,466	-7,140	-7,171	-7,358	-6,832	-5,646	-4,159	-3,813	-4,591	-6,827	-5,191	-6,639
Critical (15%)	-5,171	-5,266	-6,040	-5,551	-5,474	-3,067	-2,358	-2,134	-2,583	-2,973	-3,561	-3,911

No Action Alternative		Monthly Flow (cfs)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-3,764	-3,724	-3,812	-2,823	-666	-969	3,205	2,797	-1,150	-4,130	-2,453	-3,775
20%	-4,076	-4,560	-4,673	-2,823	-1,771	-1,394	2,207	1,304	-1,570	-6,849	-4,032	-5,147
30%	-4,613	-5,156	-5,244	-3,355	-2,823	-2,738	1,632	561	-3,500	-7,647	-5,770	-6,006
40%	-4,820	-5,627	-5,871	-4,392	-3,314	-3,500	1,268	108	-3,500	-8,888	-7,996	-7,621
50%	-5,328	-6,320	-5,871	-4,710	-3,781	-3,500	612	-182	-3,500	-9,376	-9,956	-9,000
60%	-5,589	-6,564	-5,871	-5,000	-4,878	-4,568	-102	-483	-4,487	-9,746	-10,630	-9,256
70%	-6,253	-7,101	-7,413	-5,000	-5,000	-5,000	-448	-632	-5,000	-10,301	-10,737	-9,653
80%	-6,560	-8,185	-9,537	-5,000	-5,000	-5,000	-995	-1,129	-5,000	-10,602	-10,853	-9,884
90%	-7,404	-9,995	-9,681	-5,000	-5,000	-5,000	-1,247	-1,414	-5,000	-11,108	-11,083	-10,032
Long Term												
Full Simulation Period ^b	-5,476	-6,380	-6,228	-3,535	-2,905	-2,690	919	310	-3,577	-8,496	-7,975	-7,706
Water Year Types^c												
Wet (32%)	-5,847	-7,229	-5,526	-1,900	-1,991	-1,552	3,110	2,011	-4,274	-8,957	-10,532	-9,358
Above Normal (16%)	-5,525	-6,801	-6,850	-3,699	-3,161	-4,176	1,196	412	-4,525	-9,151	-10,873	-9,542
Below Normal (13%)	-5,488	-6,749	-7,669	-4,380	-3,477	-3,919	165	-316	-3,445	-10,539	-9,624	-8,178
Dry (24%)	-5,440	-5,953	-6,676	-4,621	-3,573	-3,072	-670	-906	-3,350	-8,900	-4,745	-6,453
Critical (15%)	-4,671	-4,458	-5,006	-4,314	-2,968	-1,780	-786	-887	-1,539	-4,242	-3,168	-3,793

No Action Alternative minus Second Basis of Comparison		Monthly Flow (cfs)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-373	569	298	-241	575	-850	5,257	4,408	1,033	-675	426	-109
20%	3	873	1,370	2,015	1,094	-107	5,338	4,202	1,264	-1,697	599	-39
30%	156	1,838	1,673	2,924	1,545	554	5,589	4,738	-192	-1,159	67	387
40%	1,588	1,993	1,683	3,042	2,492	512	6,090	4,781	758	-1,733	-1,120	644
50%	1,975	2,366	2,302	3,548	2,641	1,458	6,475	5,018	1,490	-1,362	-2,016	257
60%	2,487	2,692	3,098	3,848	2,467	806	6,447	5,034	1,173	-831	-1,394	433
70%	2,822	2,497	1,913	4,269	3,323	1,205	6,682	5,376	1,016	-809	-656	325
80%	3,345	1,773	-29	4,585	3,873	1,616	6,640	5,322	1,534	-550	-489	205
90%	2,742	28	-16	4,803	4,509	2,592	6,744	5,887	1,936	-471	-400	132
Long Term												
Full Simulation Period ^b	1,504	1,464	1,201	3,115	2,301	1,037	6,300	5,152	1,034	-958	-486	211
Water Year Types^c												
Wet (32%)	2,191	1,882	2,198	3,084	1,169	-549	10,005	8,387	-250	-543	-923	320
Above Normal (16%)	895	1,086	1,110	4,566	2,928	1,155	8,229	6,173	1,499	-230	-926	344
Below Normal (13%)	2,563	2,142	419	4,210	2,273	1,582	5,535	4,638	3,133	-429	-1,589	-59
Dry (24%)	1,026	1,187	495	2,737	3,259	2,574	3,489	2,907	1,241	-2,073	446	186
Critical (15%)	500	809	1,034	1,237	2,505	1,287	1,572	1,247	1,044	-1,268	394	118

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-17-5. Old and Middle River, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-3,392	-4,293	-4,109	-2,581	-1,241	-119	-2,051	-1,611	-2,184	-3,454	-2,880	-3,666
20%	-4,079	-5,433	-6,043	-4,838	-2,865	-1,287	-3,131	-2,897	-2,834	-5,152	-4,631	-5,107
30%	-4,769	-6,994	-6,917	-6,279	-4,367	-3,292	-3,957	-4,177	-3,308	-6,488	-5,837	-6,393
40%	-6,409	-7,620	-7,554	-7,434	-5,806	-4,012	-4,821	-4,673	-4,258	-7,155	-6,876	-8,264
50%	-7,303	-8,686	-8,173	-8,257	-6,422	-4,958	-5,864	-5,200	-4,990	-8,014	-7,941	-9,257
60%	-8,076	-9,256	-8,969	-8,848	-7,346	-5,373	-6,549	-5,517	-5,660	-8,914	-9,236	-9,689
70%	-9,075	-9,598	-9,326	-9,269	-8,323	-6,205	-7,131	-6,008	-6,016	-9,492	-10,081	-9,977
80%	-9,905	-9,959	-9,508	-9,585	-8,873	-6,616	-7,635	-6,451	-6,534	-10,052	-10,364	-10,089
90%	-10,146	-10,023	-9,665	-9,803	-9,509	-7,592	-7,991	-7,302	-6,936	-10,637	-10,683	-10,163
Long Term												
Full Simulation Period ^b	-6,980	-7,844	-7,429	-6,650	-5,206	-3,727	-5,381	-4,842	-4,611	-7,538	-7,489	-7,917
Water Year Types^c												
Wet (32%)	-8,038	-9,112	-7,723	-4,985	-3,160	-1,004	-6,895	-6,376	-4,024	-8,414	-9,609	-9,678
Above Normal (16%)	-6,419	-7,887	-7,960	-8,266	-6,089	-5,331	-7,034	-5,761	-6,024	-8,921	-9,947	-9,886
Below Normal (13%)	-8,051	-8,891	-8,088	-8,590	-5,749	-5,501	-5,370	-4,954	-6,578	-10,111	-8,035	-8,118
Dry (24%)	-6,466	-7,140	-7,171	-7,358	-6,832	-5,646	-4,159	-3,813	-4,591	-6,827	-5,191	-6,639
Critical (15%)	-5,171	-5,266	-6,040	-5,551	-5,474	-3,067	-2,358	-2,134	-2,583	-2,973	-3,561	-3,911

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-3,471	-4,154	-3,935	-2,361	-447	-819	405	-673	-2,098	-3,660	-3,007	-3,495
20%	-4,101	-5,233	-5,184	-3,500	-1,896	-1,347	-946	-1,150	-4,287	-5,775	-4,278	-5,225
30%	-4,803	-6,947	-6,403	-3,500	-2,838	-2,283	-1,200	-1,150	-4,625	-7,093	-6,258	-6,437
40%	-5,638	-7,541	-6,403	-3,500	-3,500	-3,500	-2,086	-2,569	-5,017	-8,012	-7,669	-8,402
50%	-7,049	-8,326	-6,403	-5,000	-3,500	-3,500	-2,787	-3,326	-5,526	-8,990	-9,396	-9,192
60%	-8,252	-9,400	-6,811	-5,000	-4,273	-3,616	-3,368	-3,500	-5,750	-9,549	-9,845	-9,680
70%	-8,982	-9,810	-7,677	-5,000	-5,000	-5,061	-3,526	-3,500	-5,750	-10,046	-10,212	-9,842
80%	-9,734	-9,990	-8,823	-5,000	-5,621	-6,252	-4,031	-4,451	-6,160	-10,767	-10,624	-10,044
90%	-10,085	-10,084	-9,552	-6,976	-7,500	-7,499	-4,474	-5,149	-7,011	-11,148	-10,797	-10,177
Long Term												
Full Simulation Period ^b	-6,888	-7,771	-6,494	-3,764	-3,283	-3,072	-2,176	-2,623	-4,997	-8,112	-7,831	-7,917
Water Year Types^c												
Wet (32%)	-7,965	-9,052	-5,964	-2,522	-2,581	-1,646	-1,367	-2,399	-5,476	-8,581	-9,731	-9,555
Above Normal (16%)	-6,452	-8,078	-6,997	-3,789	-4,137	-5,220	-3,630	-4,226	-5,981	-9,160	-10,444	-9,839
Below Normal (13%)	-7,685	-8,790	-7,868	-4,451	-3,689	-4,765	-2,676	-2,885	-5,409	-10,929	-10,032	-8,880
Dry (24%)	-6,546	-7,086	-6,848	-4,588	-3,582	-3,358	-2,517	-2,670	-4,927	-8,172	-5,079	-6,457
Critical (15%)	-4,869	-4,871	-5,252	-4,429	-3,011	-1,804	-1,328	-1,054	-2,628	-3,280	-3,450	-3,839

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-79	139	175	220	794	-701	2,456	938	85	-205	-127	172
20%	-22	200	858	1,338	969	-61	2,185	1,747	-1,453	-623	353	-118
30%	-34	47	514	2,779	1,529	1,009	2,757	3,027	-1,317	-605	-421	-43
40%	771	79	1,151	3,934	2,306	512	2,735	2,112	-759	-857	-793	-137
50%	254	360	1,769	3,257	2,922	1,458	3,077	1,874	-536	-976	-1,455	64
60%	-177	-144	2,158	3,848	3,072	1,757	3,181	2,017	-90	-635	-609	10
70%	93	-213	1,648	4,269	3,323	1,144	3,605	2,508	266	-553	-131	136
80%	171	-31	685	4,585	3,252	365	3,604	1,999	375	-715	-259	45
90%	61	-61	112	2,827	2,009	93	3,517	2,153	-75	-511	-114	-14
Long Term												
Full Simulation Period ^b	92	73	934	2,886	1,923	656	3,205	2,219	-386	-574	-342	0
Water Year Types^c												
Wet (32%)	73	60	1,759	2,463	579	-642	5,528	3,977	-1,453	-167	-123	124
Above Normal (16%)	-32	-191	963	4,477	1,952	111	3,403	1,535	43	-240	-497	48
Below Normal (13%)	366	101	220	4,139	2,061	736	2,695	2,069	1,169	-818	-1,997	-762
Dry (24%)	-80	54	323	2,770	3,249	2,288	1,642	1,144	-336	-1,345	112	182
Critical (15%)	302	395	789	1,123	2,462	1,263	1,030	1,081	-45	-307	112	73

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-17-6. Old and Middle River, Monthly Flow

Second Basis of Comparison		Monthly Flow (cfs)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-3,392	-4,293	-4,109	-2,581	-1,241	-119	-2,051	-1,611	-2,184	-3,454	-2,880	-3,666
20%	-4,079	-5,433	-6,043	-4,838	-2,865	-1,287	-3,131	-2,897	-2,834	-5,152	-4,631	-5,107
30%	-4,769	-6,994	-6,917	-6,279	-4,367	-3,292	-3,957	-4,177	-3,308	-6,488	-5,837	-6,393
40%	-6,409	-7,620	-7,554	-7,434	-5,806	-4,012	-4,821	-4,673	-4,258	-7,155	-6,876	-8,264
50%	-7,303	-8,686	-8,173	-8,257	-6,422	-4,958	-5,864	-5,200	-4,990	-8,014	-7,941	-9,257
60%	-8,076	-9,256	-8,969	-8,848	-7,346	-5,373	-6,549	-5,517	-5,660	-8,914	-9,236	-9,689
70%	-9,075	-9,598	-9,326	-9,269	-8,323	-6,205	-7,131	-6,008	-6,016	-9,492	-10,081	-9,977
80%	-9,905	-9,959	-9,508	-9,585	-8,873	-6,616	-7,635	-6,451	-6,534	-10,052	-10,364	-10,089
90%	-10,146	-10,023	-9,665	-9,803	-9,509	-7,592	-7,991	-7,302	-6,936	-10,637	-10,683	-10,163
Long Term												
Full Simulation Period ^b	-6,980	-7,844	-7,429	-6,650	-5,206	-3,727	-5,381	-4,842	-4,611	-7,538	-7,489	-7,917
Water Year Types^c												
Wet (32%)	-8,038	-9,112	-7,723	-4,985	-3,160	-1,004	-6,895	-6,376	-4,024	-8,414	-9,609	-9,678
Above Normal (16%)	-6,419	-7,887	-7,960	-8,266	-6,089	-5,331	-7,034	-5,761	-6,024	-8,921	-9,947	-9,886
Below Normal (13%)	-8,051	-8,891	-8,088	-8,590	-5,749	-5,501	-5,370	-4,954	-6,578	-10,111	-8,035	-8,118
Dry (24%)	-6,466	-7,140	-7,171	-7,358	-6,832	-5,646	-4,159	-3,813	-4,591	-6,827	-5,191	-6,639
Critical (15%)	-5,171	-5,266	-6,040	-5,551	-5,474	-3,067	-2,358	-2,134	-2,583	-2,973	-3,561	-3,911

Alternative 5

Alternative 5		Monthly Flow (cfs)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-3,722	-3,722	-3,826	-2,823	-641	-965	3,206	2,797	-1,150	-4,455	-3,295	-3,913
20%	-4,102	-4,558	-4,737	-2,823	-1,771	-1,394	2,134	1,335	-2,319	-6,620	-4,451	-5,247
30%	-4,583	-5,162	-5,150	-3,355	-2,820	-2,738	1,566	712	-3,500	-8,001	-6,361	-6,304
40%	-4,858	-5,603	-5,871	-4,378	-3,267	-3,500	1,270	568	-3,500	-9,172	-8,612	-7,552
50%	-5,145	-6,098	-5,871	-4,710	-3,513	-3,500	623	381	-3,500	-9,522	-10,244	-8,864
60%	-5,368	-6,494	-5,871	-5,000	-4,878	-4,568	381	381	-4,467	-9,822	-10,615	-9,232
70%	-6,237	-7,087	-7,453	-5,000	-5,000	-5,000	381	381	-5,000	-10,430	-10,756	-9,654
80%	-6,583	-8,086	-9,466	-5,000	-5,000	-5,000	381	381	-5,000	-10,694	-10,844	-9,915
90%	-7,355	-9,871	-9,681	-5,000	-5,000	-5,000	381	381	-5,000	-11,168	-11,076	-10,031
Long Term												
Full Simulation Period ^b	-5,443	-6,337	-6,246	-3,551	-2,904	-2,710	1,482	1,034	-3,631	-8,687	-8,239	-7,714
Water Year Types^c												
Wet (32%)	-5,812	-7,354	-5,572	-1,900	-1,926	-1,598	3,122	2,182	-4,275	-8,965	-10,573	-9,193
Above Normal (16%)	-5,543	-6,368	-6,838	-3,716	-3,222	-4,174	1,292	780	-4,521	-9,187	-10,817	-9,491
Below Normal (13%)	-5,418	-6,748	-7,637	-4,380	-3,554	-3,971	718	468	-3,444	-10,623	-9,770	-8,460
Dry (24%)	-5,380	-5,893	-6,731	-4,620	-3,578	-3,074	565	453	-3,523	-9,446	-5,313	-6,571
Critical (15%)	-4,661	-4,461	-4,983	-4,409	-2,957	-1,770	363	310	-1,623	-4,501	-3,860	-3,805

Alternative 5 minus Second Basis of Comparison

Alternative 5 minus Second Basis of Comparison		Monthly Flow (cfs)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-331	571	284	-241	600	-846	5,257	4,408	1,033	-1,001	-415	-247
20%	-23	875	1,306	2,015	1,094	-107	5,265	4,233	516	-1,468	180	-140
30%	186	1,832	1,767	2,924	1,548	554	5,522	4,889	-192	-1,514	-524	89
40%	1,551	2,016	1,683	3,056	2,539	512	6,091	5,240	758	-2,017	-1,736	712
50%	2,158	2,588	2,302	3,548	2,909	1,458	6,487	5,582	1,490	-1,507	-2,303	393
60%	2,707	2,762	3,098	3,848	2,467	806	6,930	5,899	1,193	-907	-1,378	458
70%	2,838	2,511	1,873	4,269	3,323	1,205	7,512	6,390	1,016	-937	-675	323
80%	3,322	1,872	42	4,585	3,873	1,616	8,016	6,832	1,534	-642	-479	174
90%	2,791	152	-16	4,803	4,509	2,592	8,372	7,683	1,936	-531	-393	132
Long Term												
Full Simulation Period ^b	1,537	1,508	1,182	3,099	2,302	1,017	6,863	5,876	980	-1,149	-750	203
Water Year Types^c												
Wet (32%)	2,226	1,758	2,151	3,084	1,234	-595	10,017	8,558	-251	-552	-964	485
Above Normal (16%)	876	1,519	1,122	4,550	2,867	1,158	8,325	6,541	1,503	-266	-871	395
Below Normal (13%)	2,633	2,144	450	4,210	2,196	1,530	6,088	5,422	3,134	-512	-1,735	-342
Dry (24%)	1,086	1,247	439	2,738	3,254	2,573	4,724	4,266	1,068	-2,620	-122	68
Critical (15%)	510	805	1,058	1,142	2,516	1,296	2,721	2,445	961	-1,528	-298	107

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1 **C.18. Exports through Jones and Banks Pumping Plants**


Figure C-18-1-1. Exports Through Jones and Banks Pumping Plants, Long-Term* Average Flow

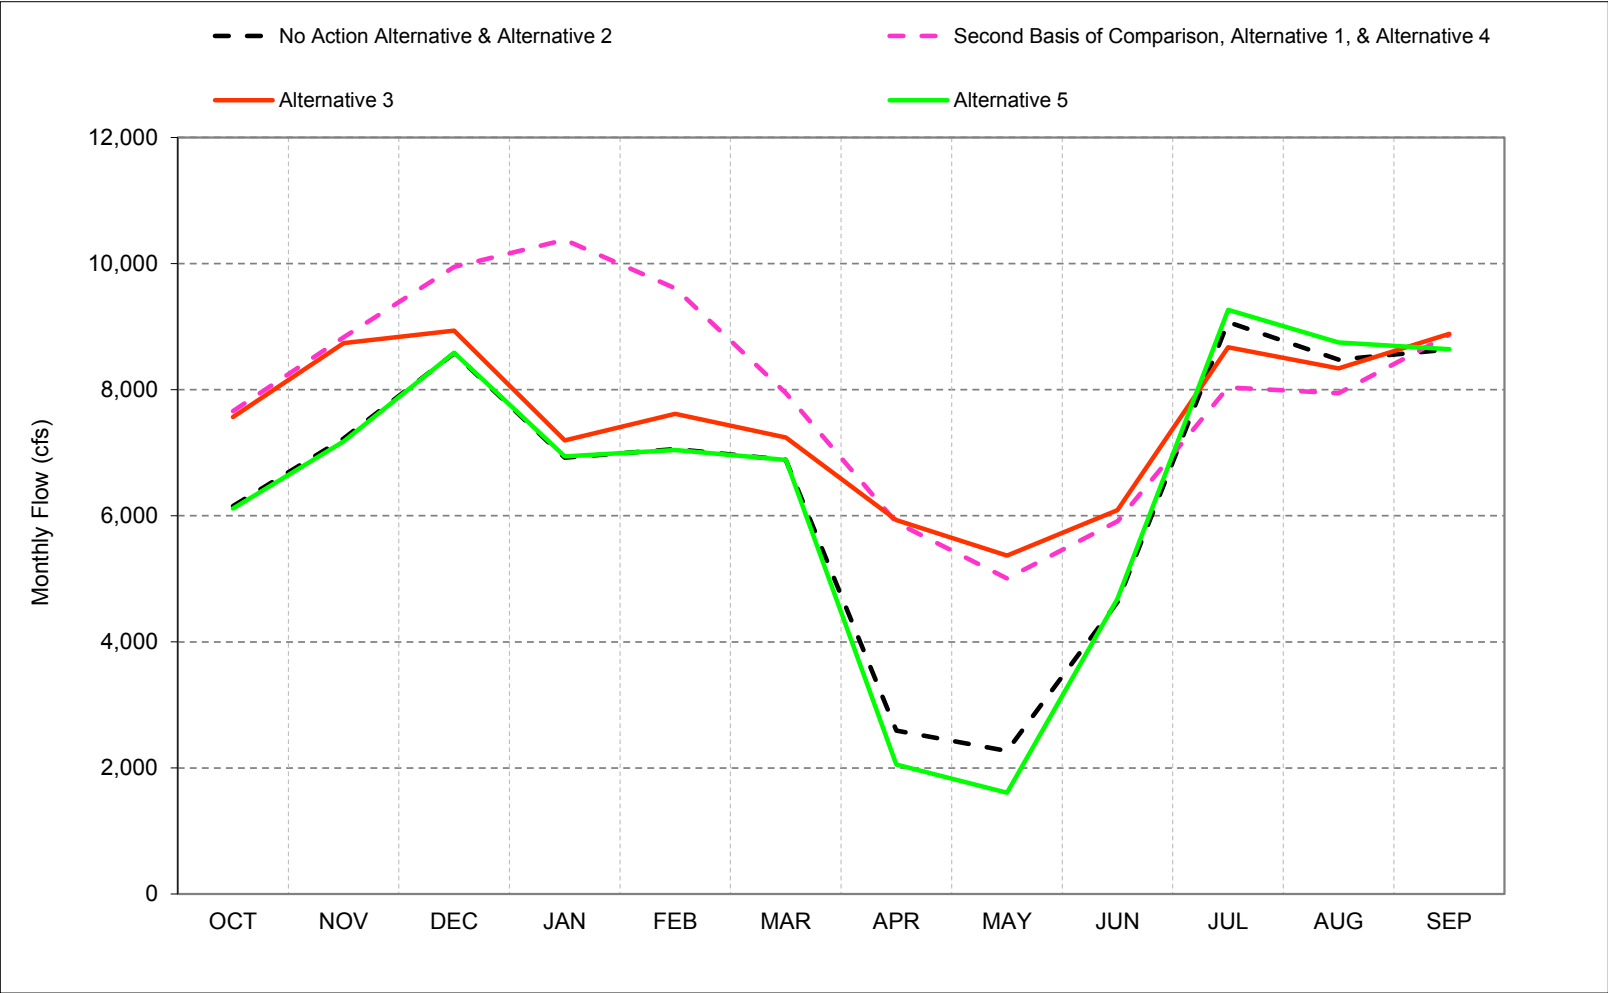

*Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-18-1-2. Exports Through Jones and Banks Pumping Plants, Wet Year* Long-Term** Average Flow

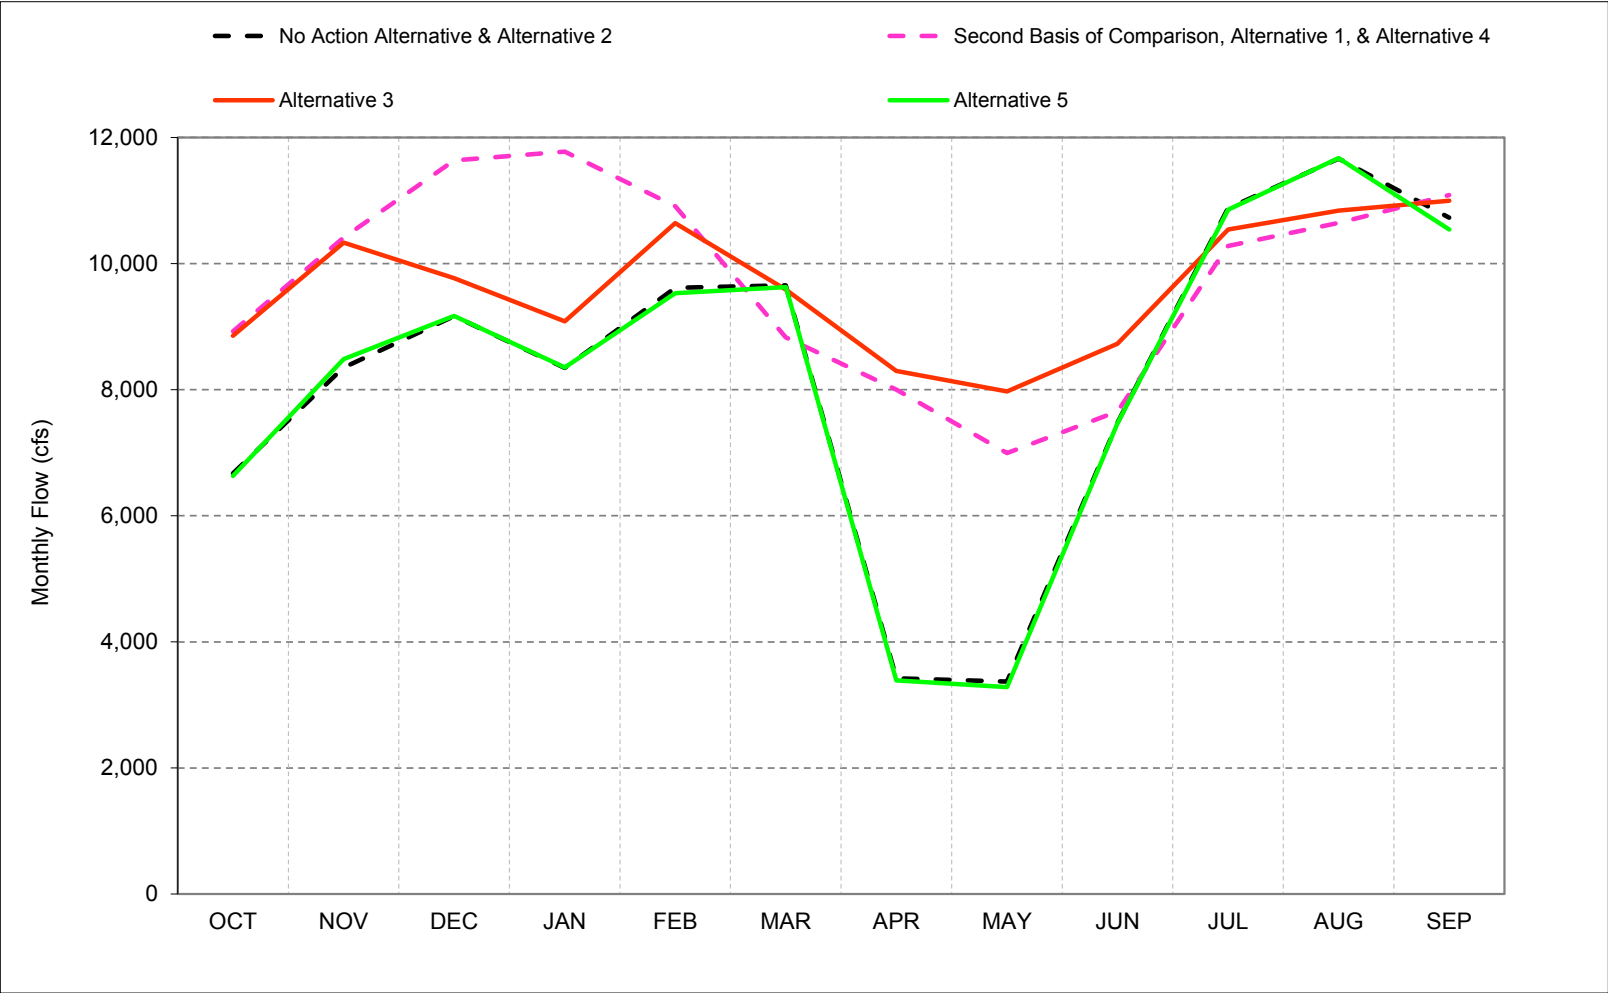


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-18-1-3. Exports Through Jones and Banks Pumping Plants, Above Normal Year* Long-Term** Average Flow

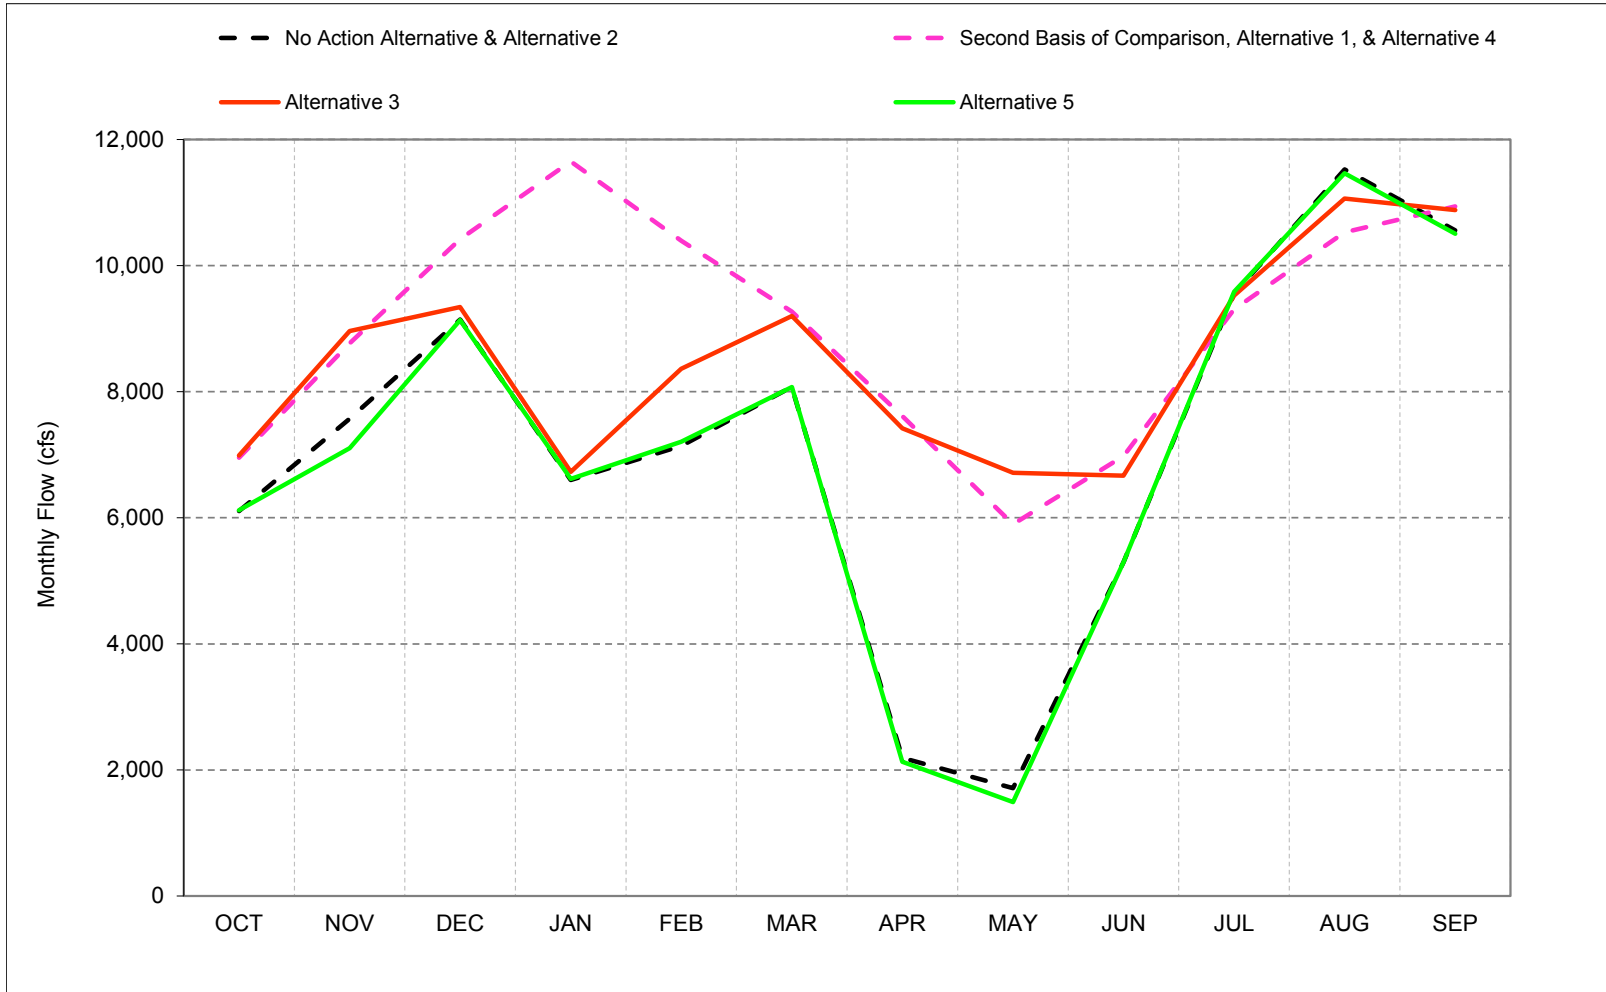


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-18-1-4. Exports Through Jones and Banks Pumping Plants, Below Normal Year* Long-Term** Average Flow

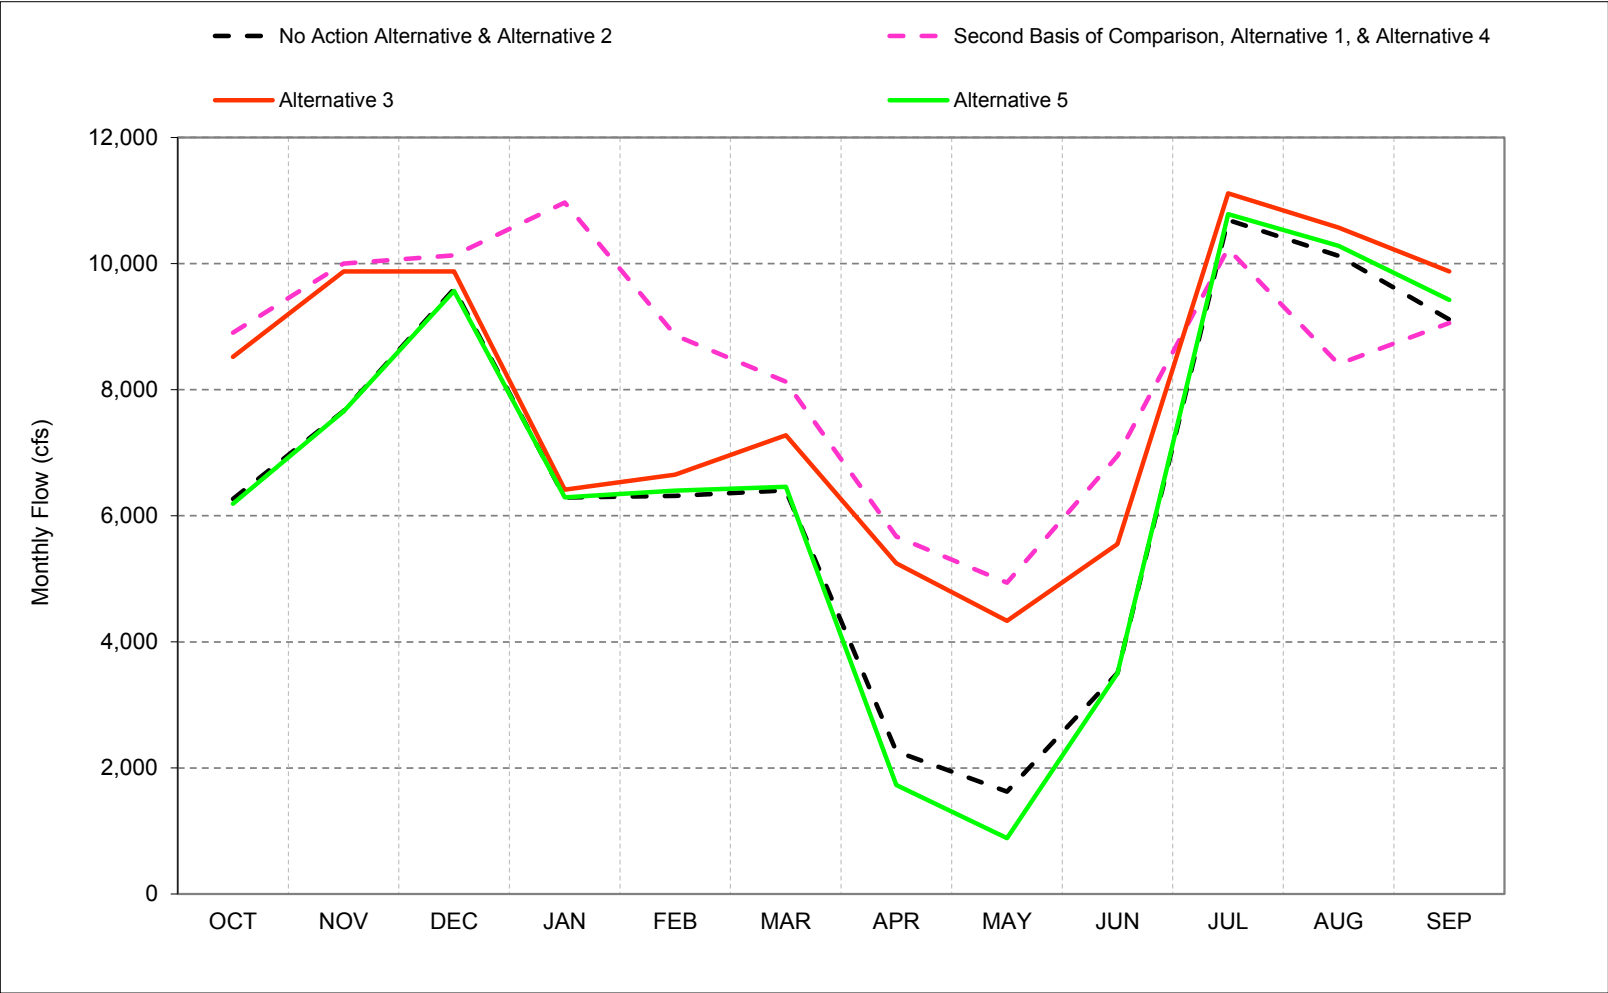


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-18-1-5. Exports Through Jones and Banks Pumping Plants, Dry Year* Long-Term** Average Flow

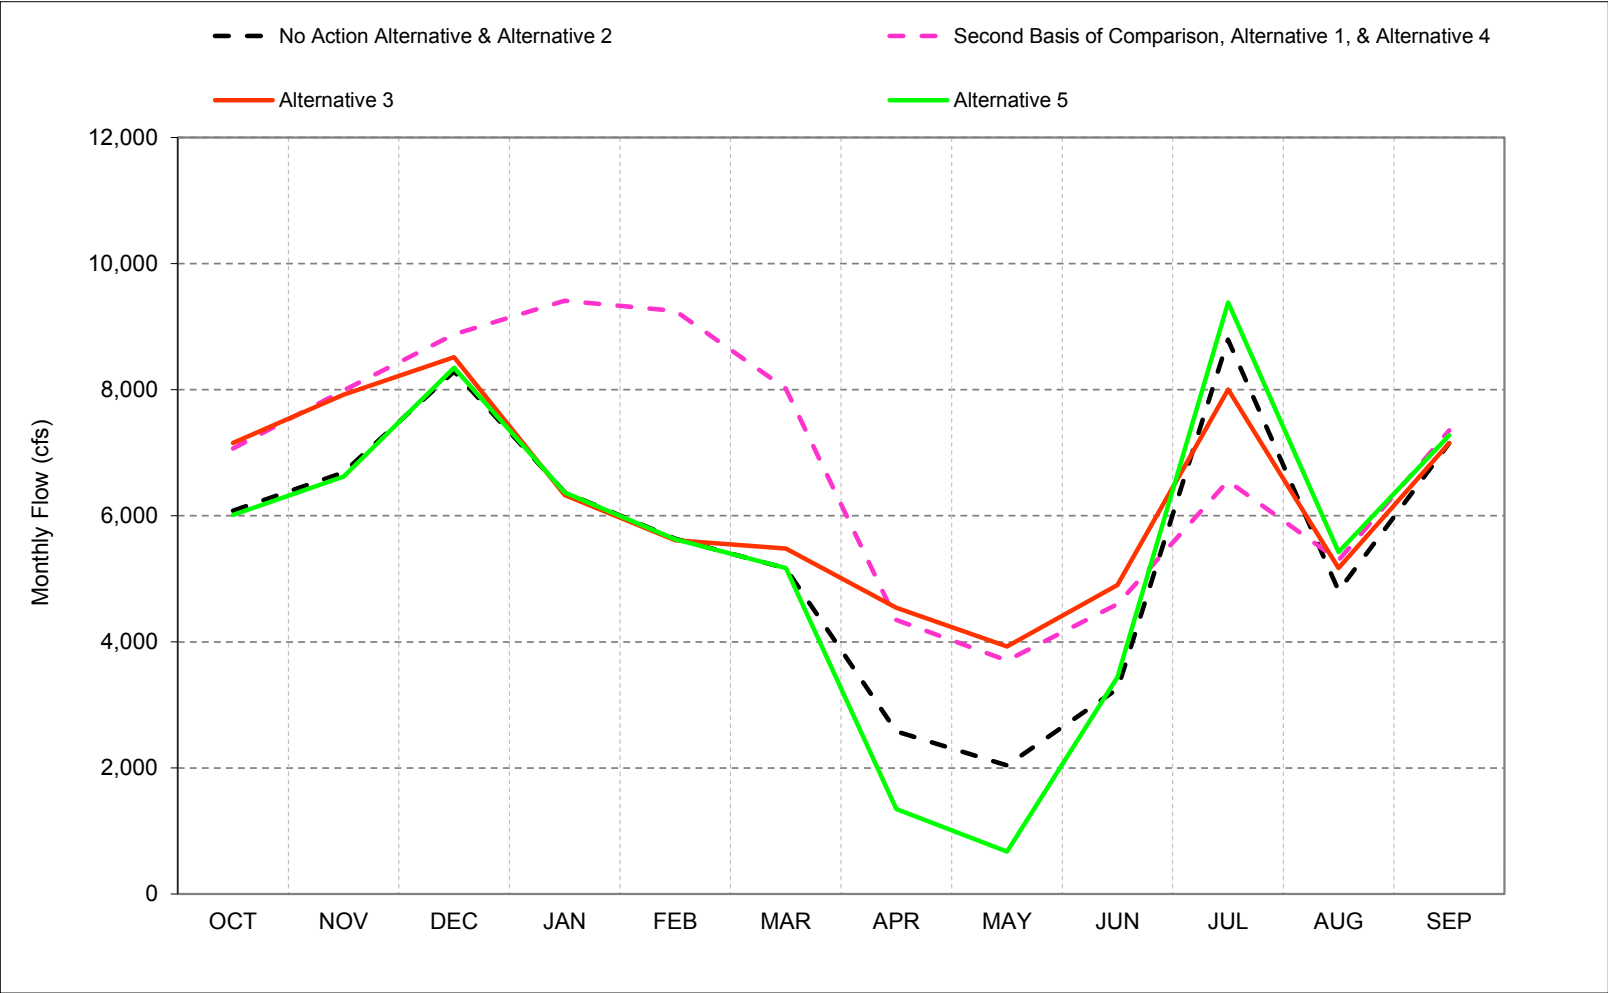


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-18-1-6. Exports Through Jones and Banks Pumping Plants, Critical Year* Long-Term** Average Flow

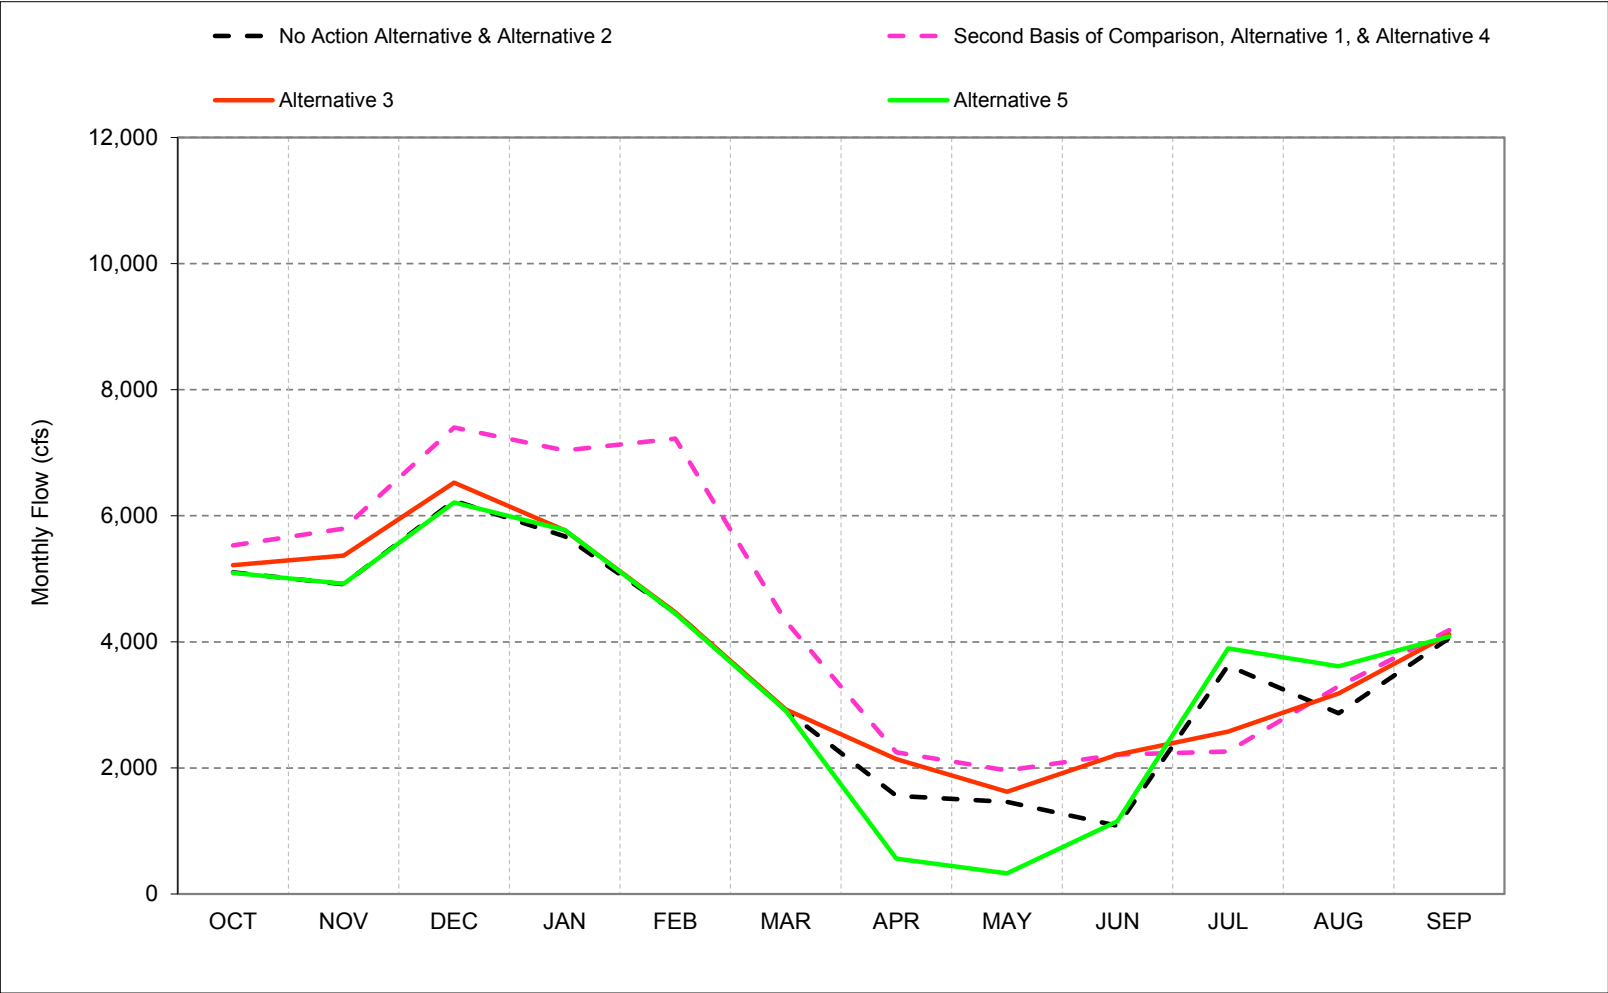


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-18-2-1. Exports Through Jones and Banks Pumping Plants, October

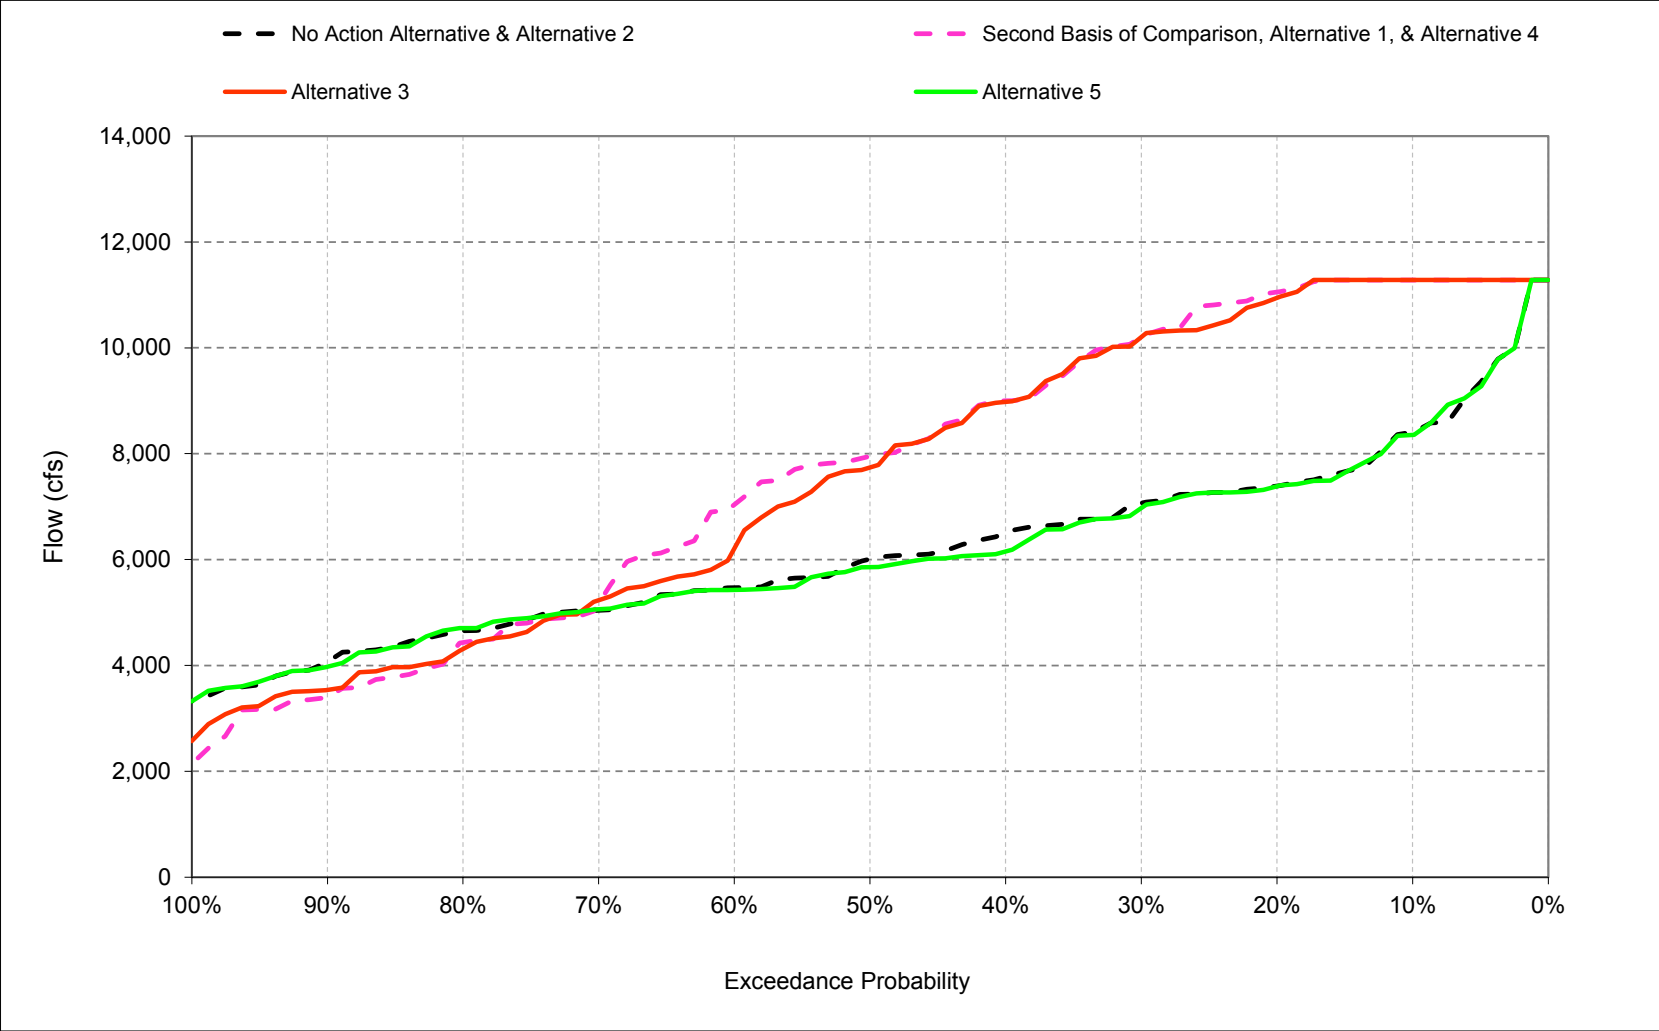


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-18-2-2. Exports Through Jones and Banks Pumping Plants, November

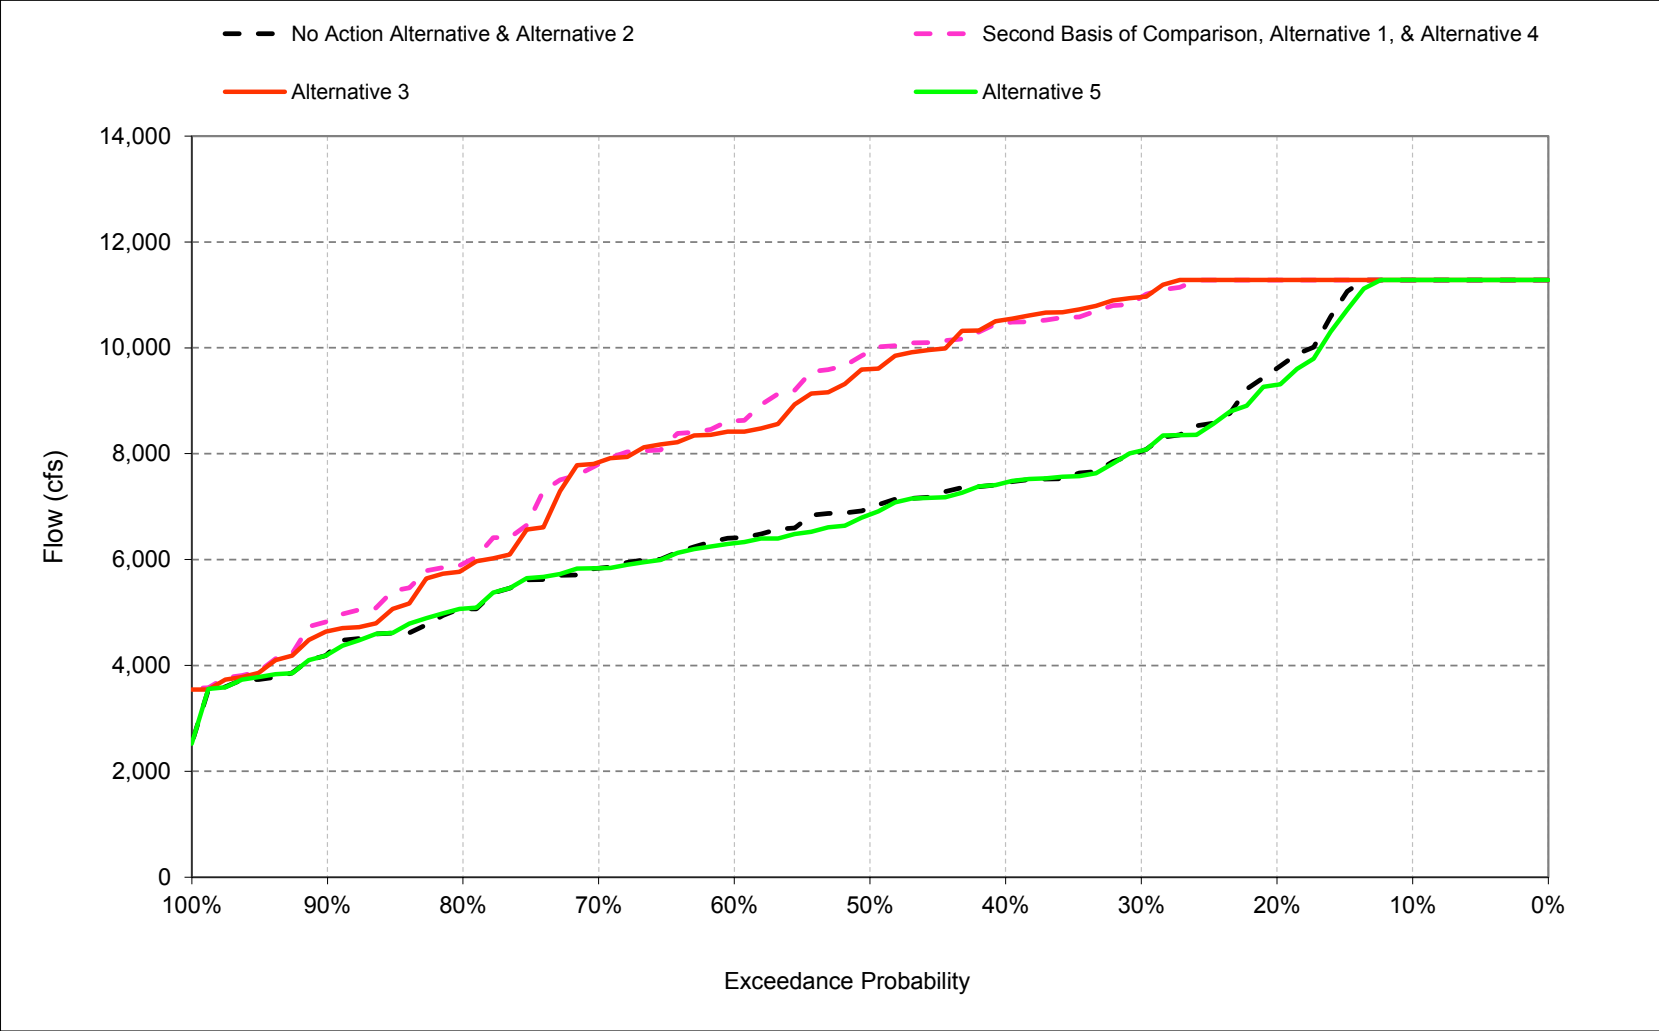


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-18-2-3. Exports Through Jones and Banks Pumping Plants, December

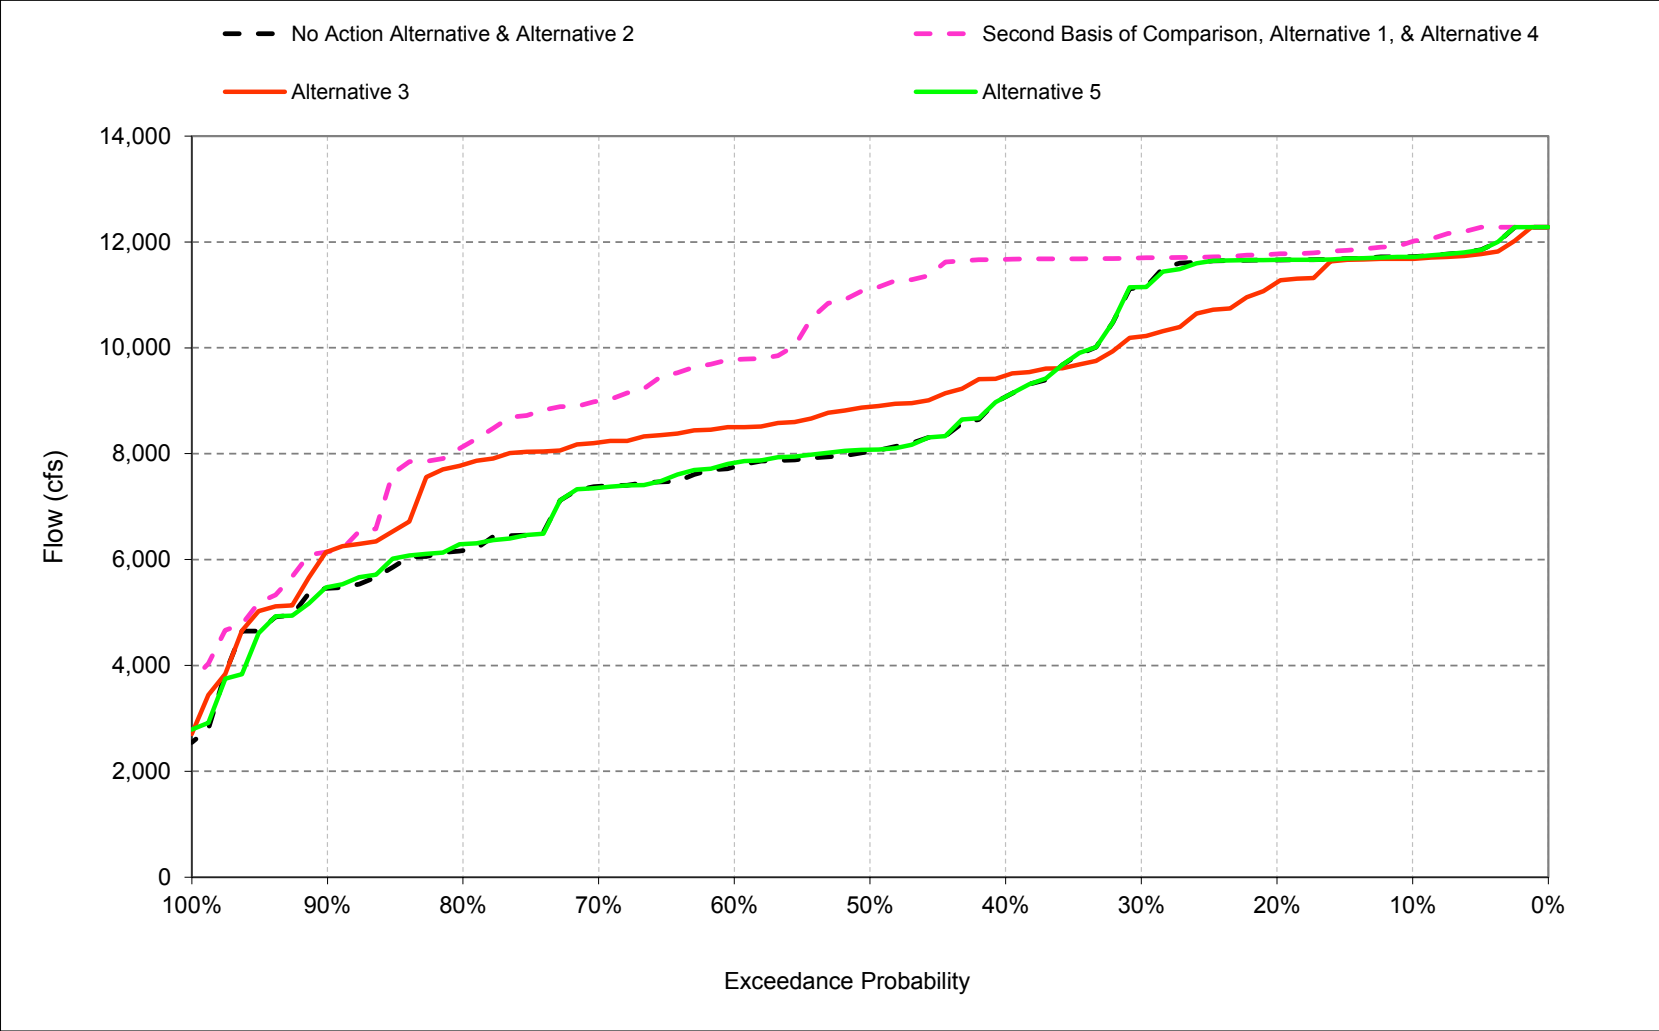


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-18-2-4. Exports Through Jones and Banks Pumping Plants, January

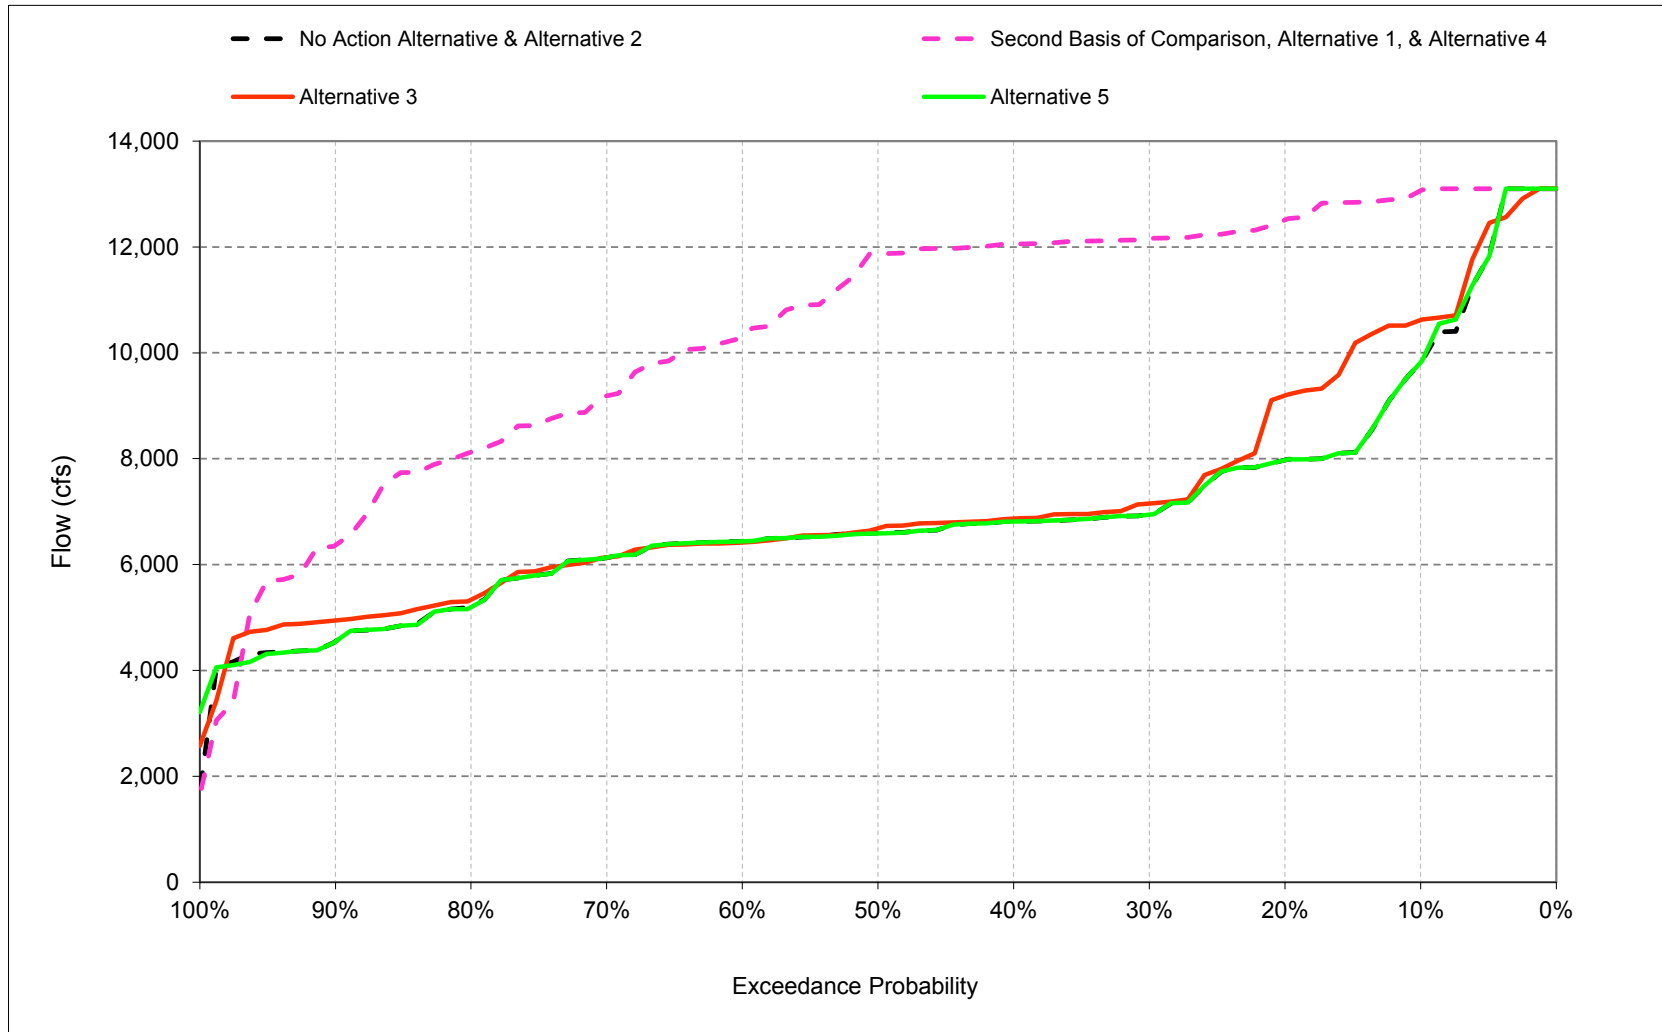


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-18-2-5. Exports Through Jones and Banks Pumping Plants, February

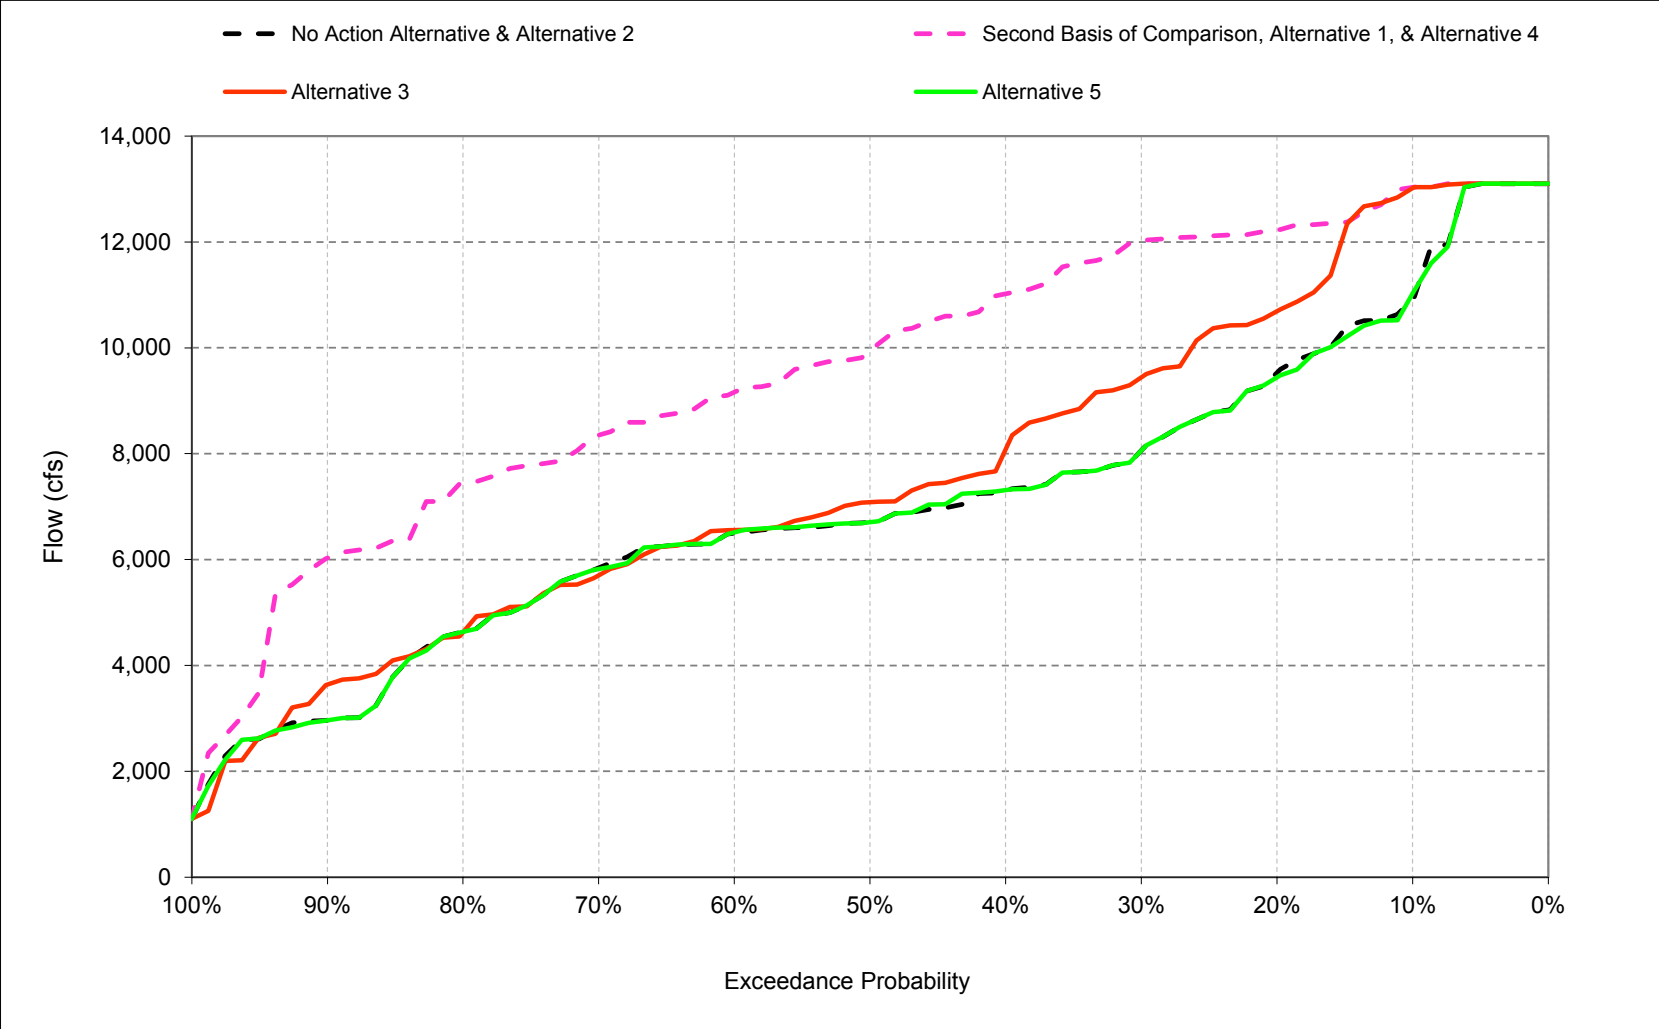


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-18-2-6. Exports Through Jones and Banks Pumping Plants, March

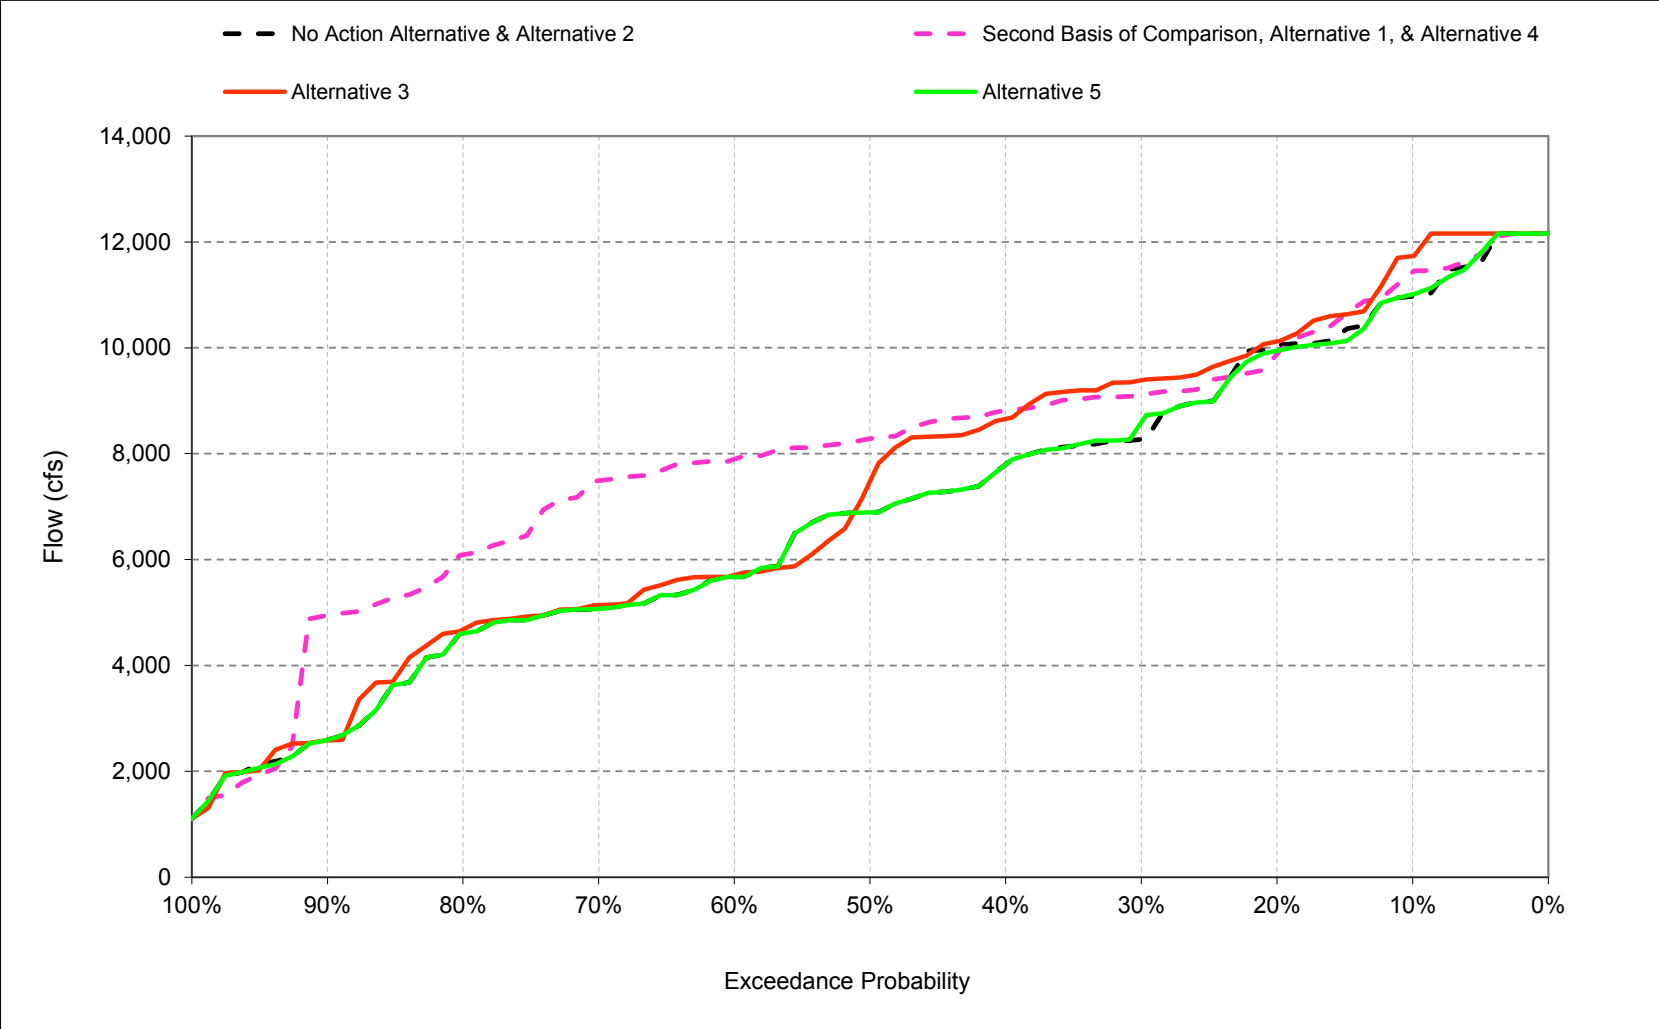


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-18-2-7. Exports Through Jones and Banks Pumping Plants, April

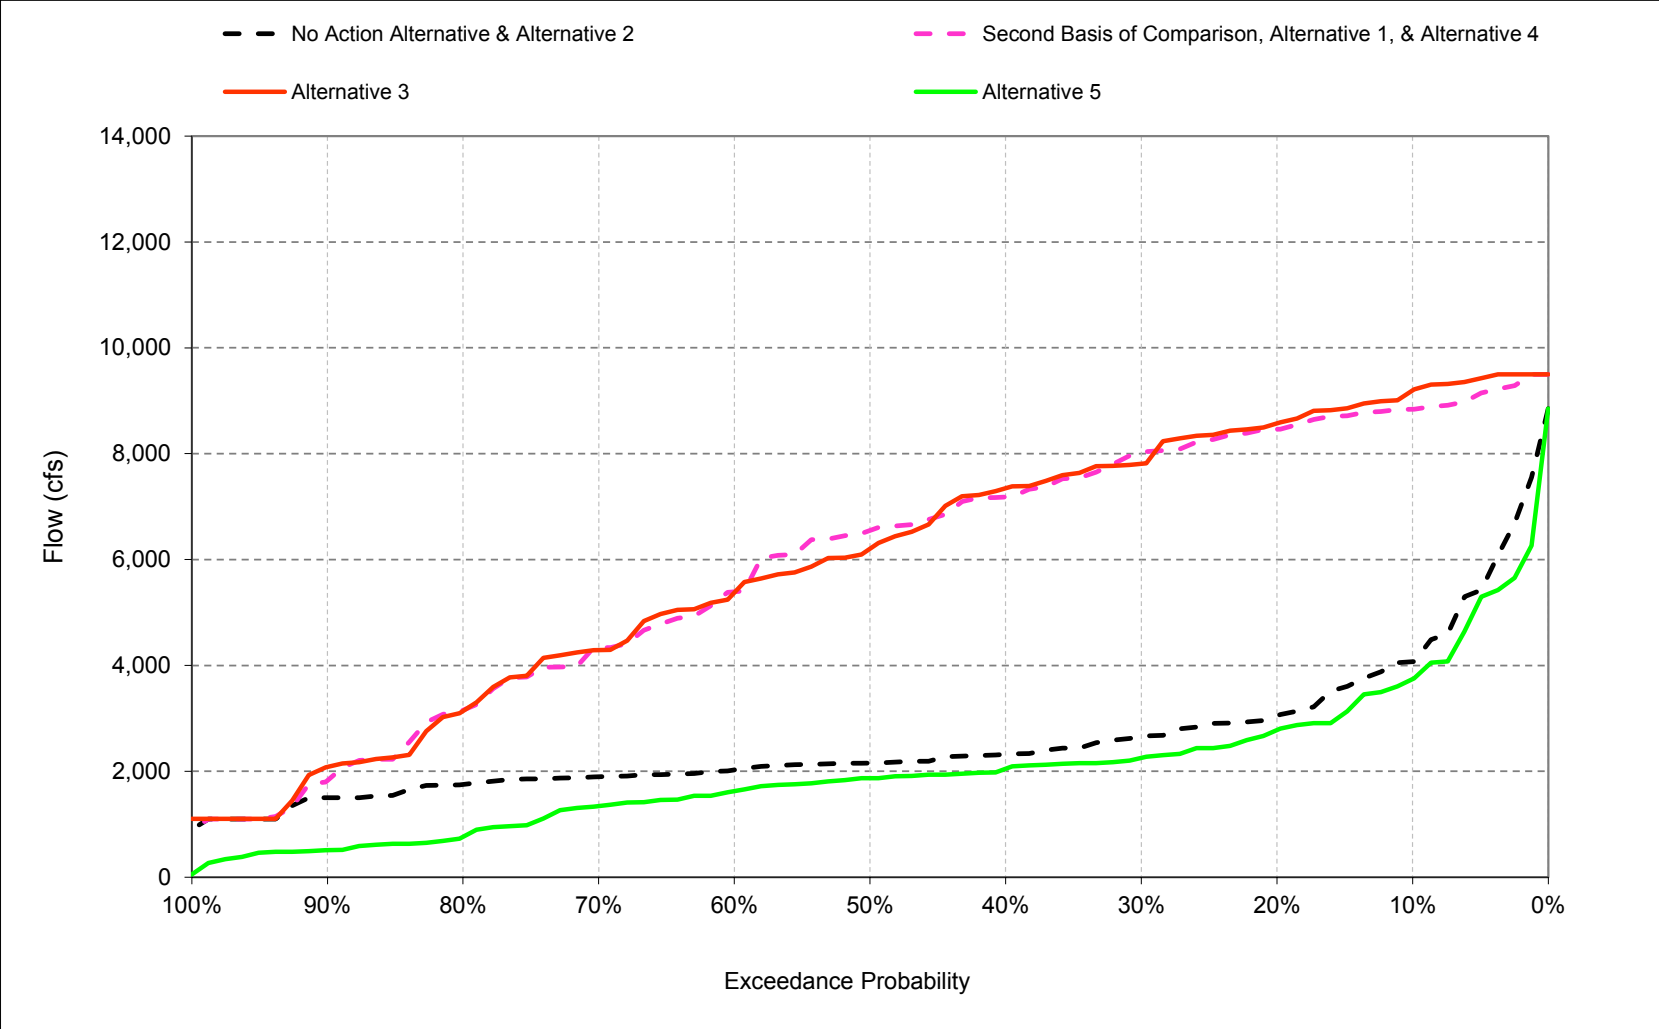


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-18-2-8. Exports Through Jones and Banks Pumping Plants, May

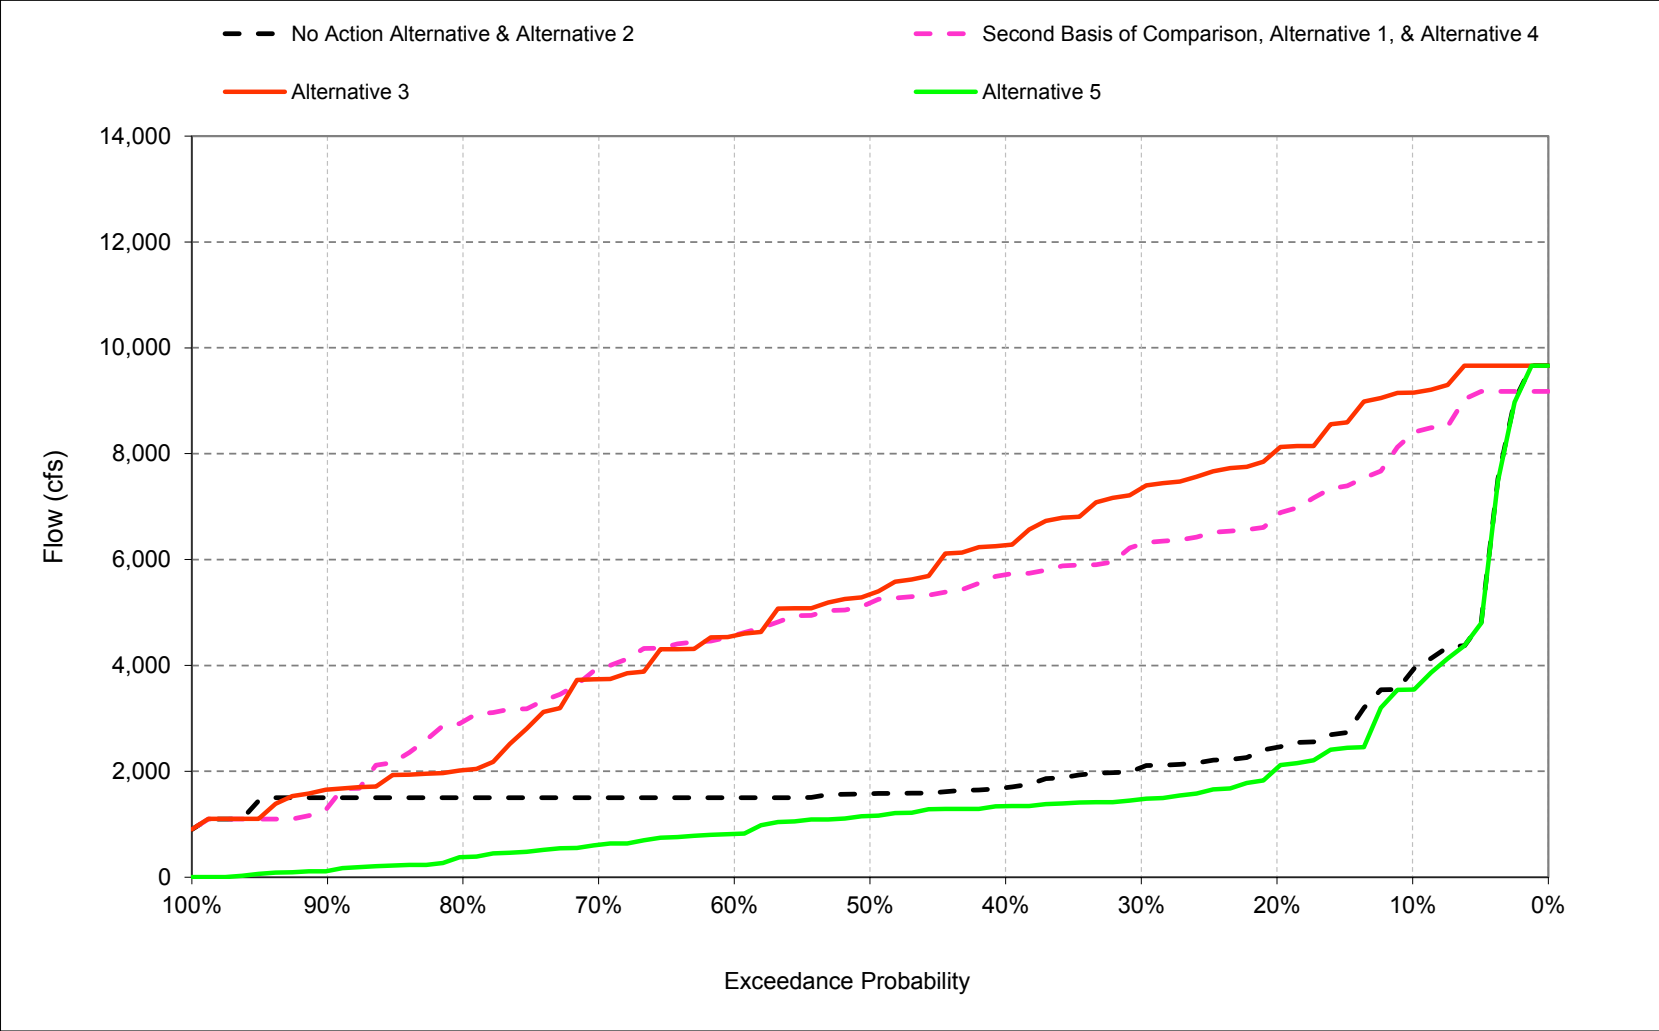


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-18-2-9. Exports Through Jones and Banks Pumping Plants, June

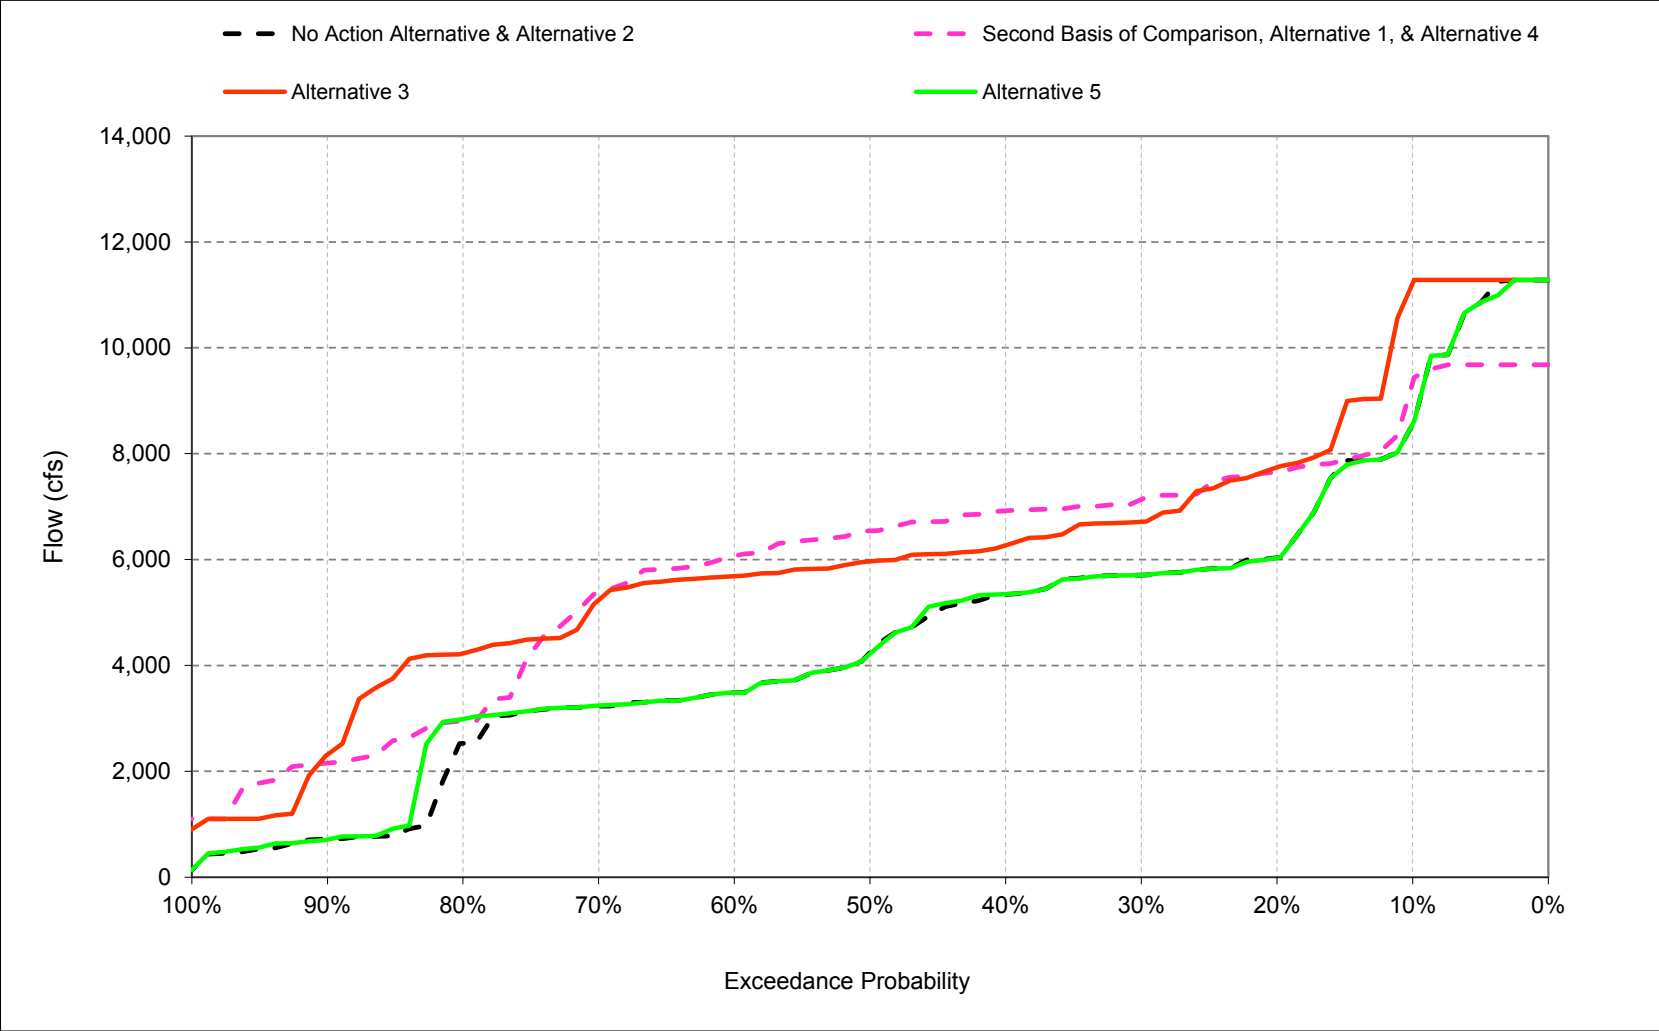


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-18-2-10. Exports Through Jones and Banks Pumping Plants, July

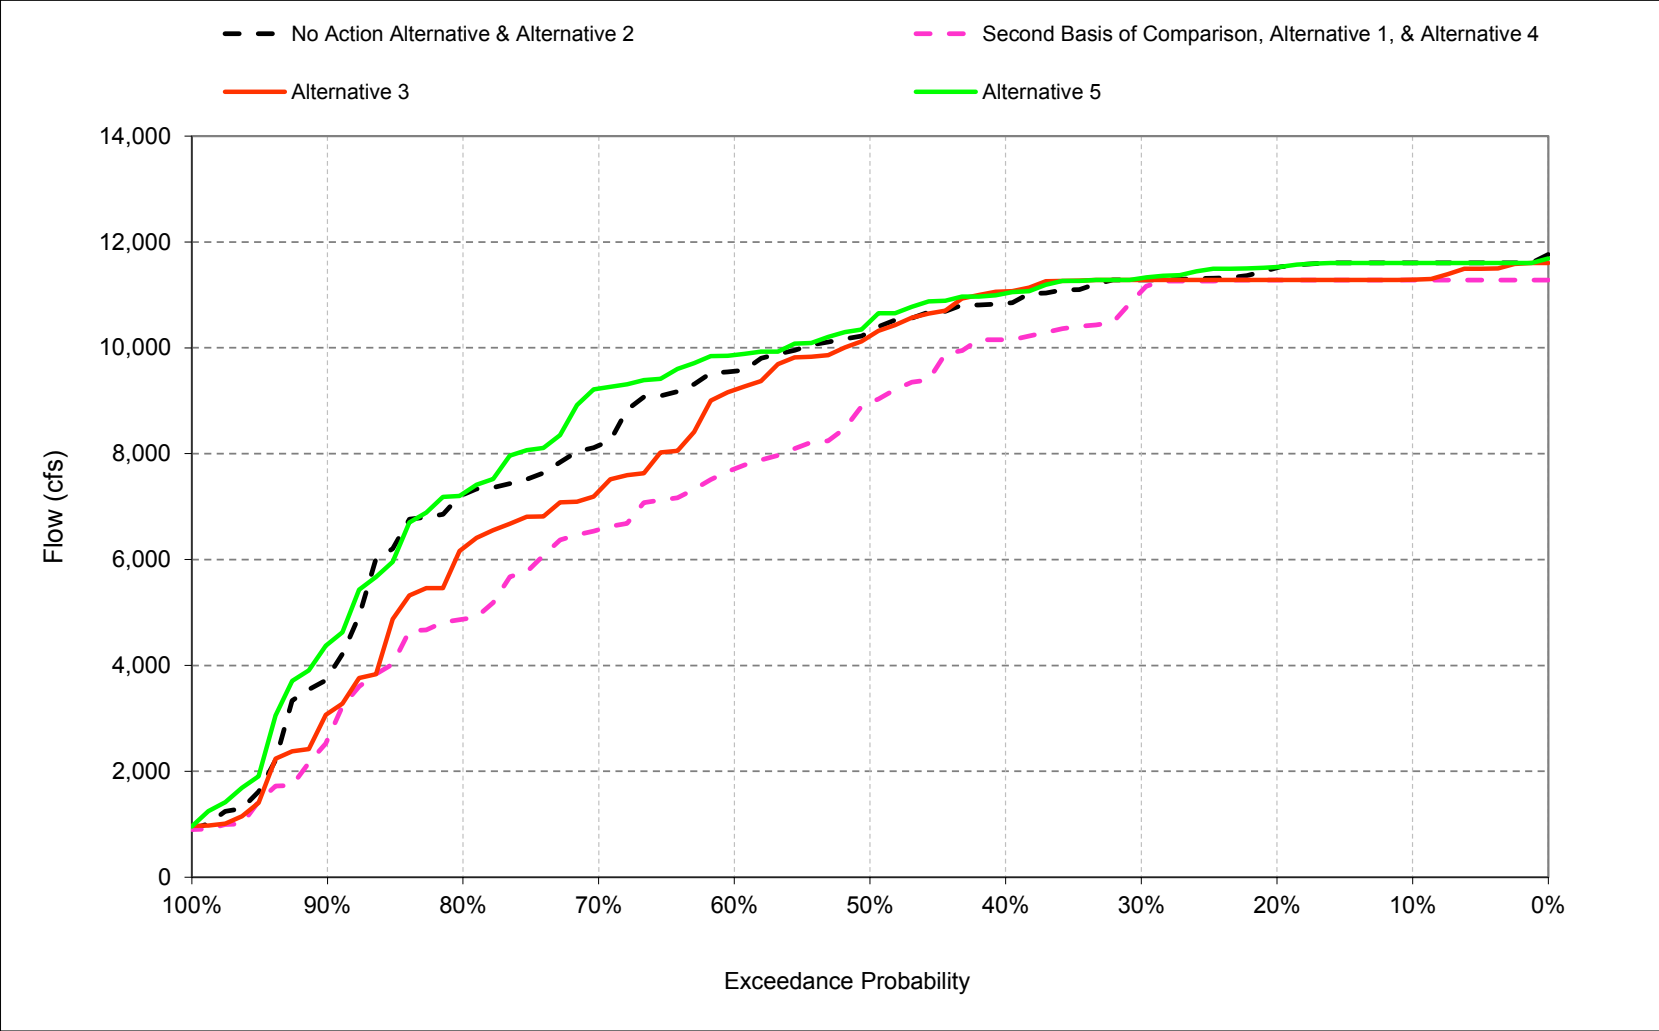


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-18-2-11. Exports Through Jones and Banks Pumping Plants, August

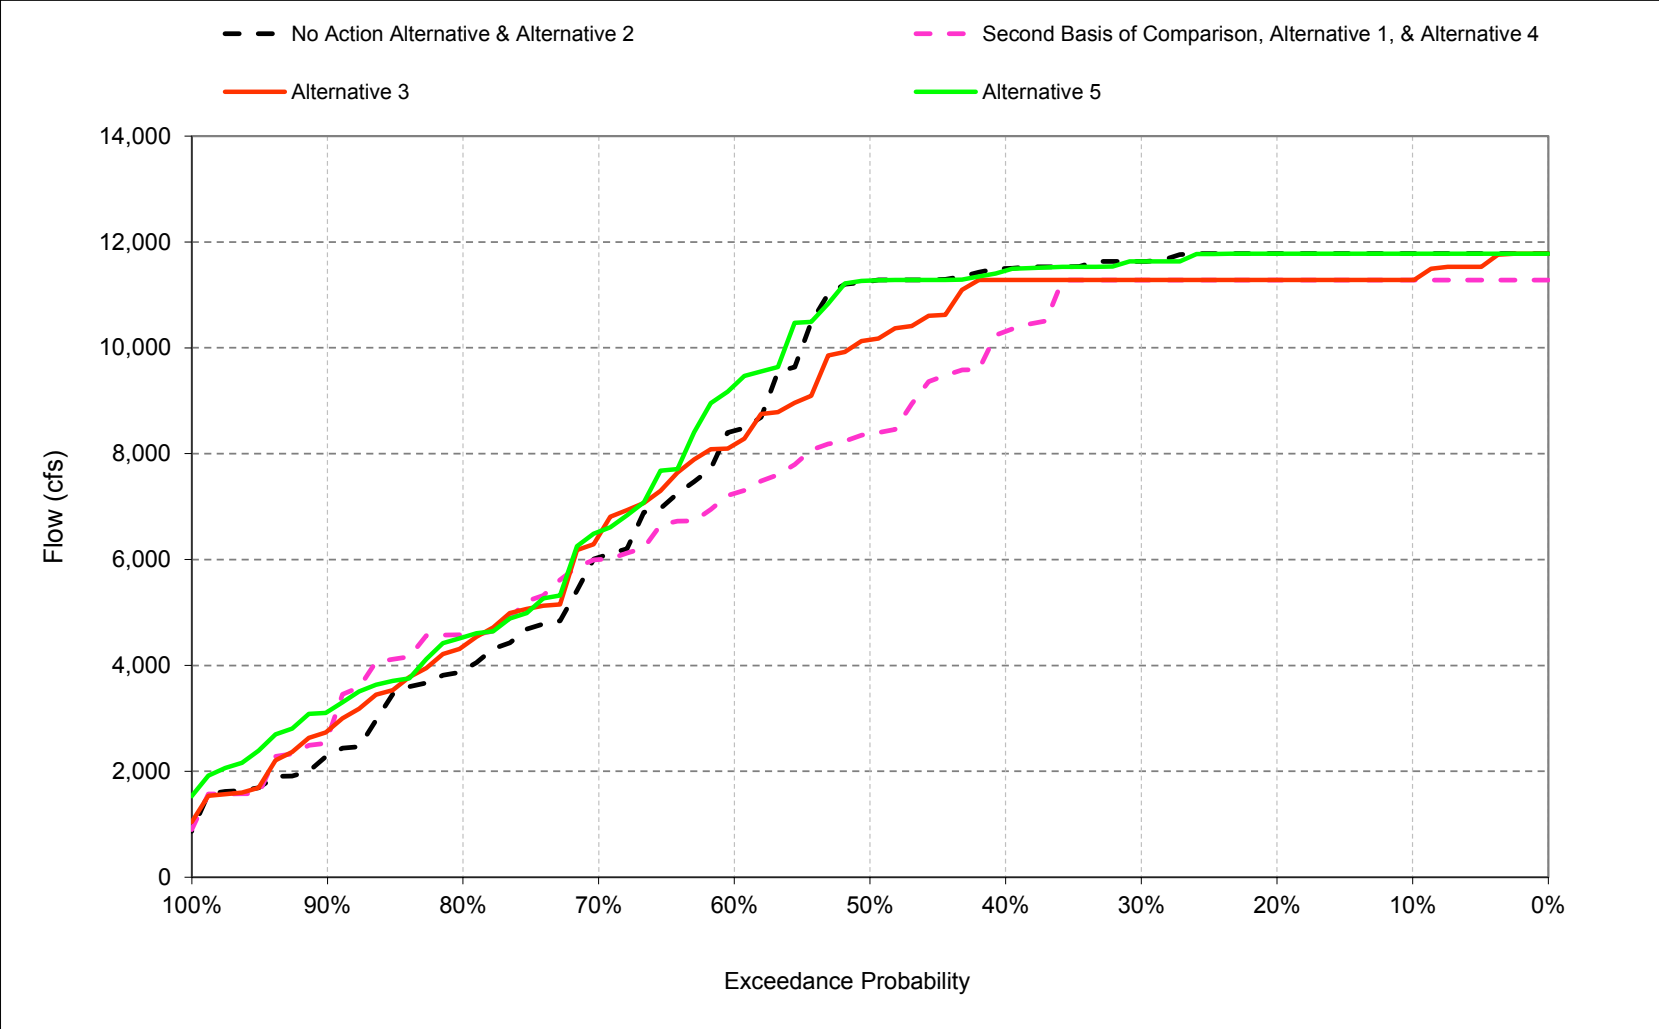

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-18-2-12. Exports Through Jones and Banks Pumping Plants, September

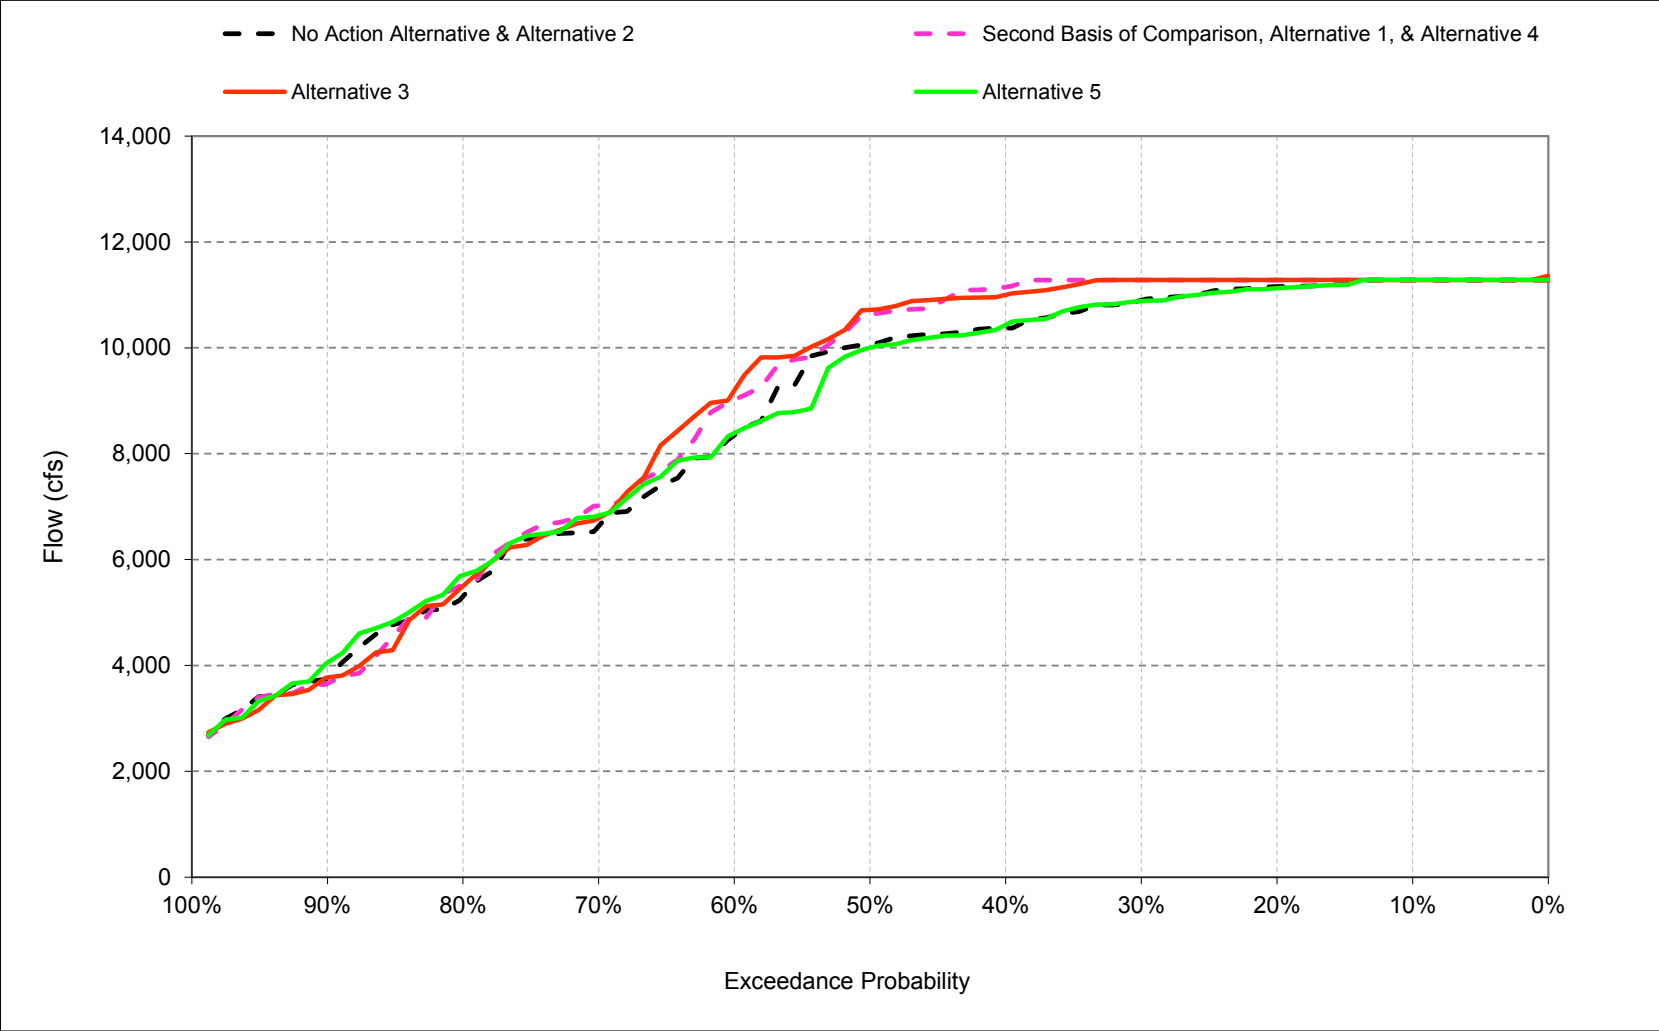

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-18-1-1. Exports Through Jones and Banks Pumping Plants, Monthly Export Rate

No Action Alternative												
Statistic	Monthly Export Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	8,412	11,280	11,725	9,816	10,924	10,973	4,073	3,906	8,550	11,605	11,780	11,280
20%	7,390	9,616	11,661	7,974	9,529	10,037	3,049	2,454	6,033	11,512	11,780	11,158
30%	7,065	8,047	11,142	6,944	8,059	8,270	2,653	2,073	5,707	11,280	11,630	10,941
40%	6,502	7,448	9,074	6,813	7,307	7,796	2,320	1,690	5,343	10,841	11,500	10,468
50%	6,011	6,980	8,042	6,597	6,707	6,893	2,157	1,575	4,248	10,312	11,257	10,146
60%	5,469	6,409	7,751	6,440	6,495	5,672	2,027	1,500	3,484	9,557	8,434	8,546
70%	5,041	5,834	7,383	6,130	5,846	5,073	1,898	1,500	3,232	8,156	6,039	6,891
80%	4,653	5,070	6,170	5,217	4,636	4,607	1,752	1,500	2,529	7,224	3,907	5,631
90%	4,068	4,215	5,455	4,546	2,963	2,592	1,500	1,500	720	3,768	2,291	4,090
Long Term												
Full Simulation Period ^b	6,155	7,225	8,578	6,921	7,056	6,887	2,593	2,270	4,634	9,071	8,476	8,636
Water Year Types^c												
Wet (32%)	6,674	8,350	9,168	8,346	9,616	9,656	3,424	3,371	7,479	10,876	11,663	10,727
Above Normal (16%)	6,108	7,568	9,145	6,598	7,142	8,074	2,193	1,712	5,297	9,549	11,524	10,558
Below Normal (13%)	6,270	7,660	9,597	6,291	6,316	6,402	2,260	1,625	3,509	10,692	10,123	9,114
Dry (24%)	6,080	6,687	8,287	6,372	5,633	5,167	2,578	2,041	3,255	8,793	4,808	7,151
Critical (15%)	5,104	4,916	6,238	5,672	4,467	2,915	1,558	1,465	1,083	3,621	2,869	4,060

Alternative 1												
Statistic	Monthly Export Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	11,280	11,280	12,011	13,065	13,032	11,429	8,841	8,382	9,334	11,280	11,280	11,280
20%	11,055	11,280	11,772	12,511	12,226	9,882	8,461	6,831	7,652	11,280	11,280	11,280
30%	10,198	10,956	11,699	12,155	12,020	9,114	8,015	6,289	7,137	11,065	11,280	11,280
40%	9,001	10,469	11,672	12,056	11,020	8,815	7,182	5,713	6,920	10,154	10,308	11,235
50%	7,952	9,934	11,110	11,874	9,946	8,283	6,552	5,183	6,543	8,966	8,374	10,679
60%	7,037	8,619	9,776	10,334	9,164	7,898	5,392	4,566	6,067	7,712	7,250	9,166
70%	5,177	7,803	8,992	9,187	8,353	7,489	4,337	3,930	5,372	6,565	6,000	7,066
80%	4,433	5,919	8,133	8,123	7,442	6,091	3,152	2,936	2,951	4,873	4,578	5,708
90%	3,405	4,838	6,145	6,367	6,030	4,944	1,825	1,309	2,153	2,596	2,623	3,805
Long Term												
Full Simulation Period ^b	7,660	8,828	9,949	10,376	9,608	7,948	5,893	5,006	5,913	8,036	7,945	8,870
Water Year Types^c												
Wet (32%)	8,927	10,409	11,637	11,774	10,908	8,829	7,999	6,994	7,657	10,279	10,645	11,087
Above Normal (16%)	6,953	8,763	10,418	11,650	10,392	9,269	7,610	5,897	6,980	9,306	10,525	10,937
Below Normal (13%)	8,905	9,999	10,129	10,967	8,862	8,126	5,670	4,939	6,952	10,234	8,407	9,055
Dry (24%)	7,067	7,987	8,879	9,410	9,250	8,016	4,349	3,704	4,602	6,552	5,293	7,354
Critical (15%)	5,530	5,798	7,399	7,037	7,223	4,330	2,248	1,961	2,213	2,260	3,297	4,187

Alternative 1 minus No Action Alternative												
Statistic	Monthly Export Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,868	0	286	3,249	2,108	456	4,767	4,476	784	-325	-500	0
20%	3,665	1,664	111	4,538	2,696	-155	5,412	4,377	1,619	-232	-500	122
30%	3,133	2,909	557	5,211	3,961	844	5,362	4,216	1,430	-215	-350	339
40%	2,499	3,022	2,598	5,242	3,713	1,019	4,862	4,023	1,577	-687	-1,192	767
50%	1,941	2,954	3,069	5,277	3,239	1,390	4,395	3,608	2,296	-1,346	-2,884	533
60%	1,569	2,209	2,025	3,894	2,669	2,226	3,365	3,066	2,583	-1,845	-1,184	620
70%	136	1,969	1,609	3,057	2,508	2,416	2,439	2,430	2,141	-1,591	-39	175
80%	-220	849	1,963	2,906	2,806	1,484	1,400	1,436	422	-2,351	671	77
90%	-663	623	690	1,821	3,067	2,352	325	-191	1,433	-1,172	332	-285
Long Term												
Full Simulation Period ^b	1,505	1,603	1,370	3,456	2,552	1,060	3,300	2,735	1,279	-1,035	-531	234
Water Year Types^c												
Wet (32%)	2,253	2,060	2,469	3,428	1,292	-827	4,575	3,624	178	-597	-1,018	360
Above Normal (16%)	845	1,195	1,273	5,052	3,249	1,195	5,417	4,185	1,682	-243	-999	379
Below Normal (13%)	2,636	2,339	532	4,676	2,546	1,724	3,410	3,313	3,443	-457	-1,716	-59
Dry (24%)	987	1,300	592	3,038	3,616	2,848	1,771	1,663	1,347	-2,241	485	203
Critical (15%)	427	882	1,161	1,364	2,756	1,415	690	497	1,131	-1,361	427	127

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
^b Based on the 82-year simulation period.
^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-18-1-2. Exports Through Jones and Banks Pumping Plants, Monthly Export Rate

No Action Alternative												
Statistic	Monthly Export Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	8,412	11,280	11,725	9,816	10,924	10,973	4,073	3,906	8,550	11,605	11,780	11,280
20%	7,390	9,616	11,661	7,974	9,529	10,037	3,049	2,454	6,033	11,512	11,780	11,158
30%	7,065	8,047	11,142	6,944	8,059	8,270	2,653	2,073	5,707	11,280	11,630	10,941
40%	6,502	7,448	9,074	6,813	7,307	7,796	2,320	1,690	5,343	10,841	11,500	10,468
50%	6,011	6,980	8,042	6,597	6,707	6,893	2,157	1,575	4,248	10,312	11,257	10,146
60%	5,469	6,409	7,751	6,440	6,495	5,672	2,027	1,500	3,484	9,557	8,434	8,546
70%	5,041	5,834	7,383	6,130	5,846	5,073	1,898	1,500	3,232	8,156	6,039	6,891
80%	4,653	5,070	6,170	5,217	4,636	4,607	1,752	1,500	2,529	7,224	3,907	5,631
90%	4,068	4,215	5,455	4,546	2,963	2,592	1,500	1,500	720	3,768	2,291	4,090
Long Term												
Full Simulation Period ^b	6,155	7,225	8,578	6,921	7,056	6,887	2,593	2,270	4,634	9,071	8,476	8,636
Water Year Types^c												
Wet (32%)	6,674	8,350	9,168	8,346	9,616	9,656	3,424	3,371	7,479	10,876	11,663	10,727
Above Normal (16%)	6,108	7,568	9,145	6,598	7,142	8,074	2,193	1,712	5,297	9,549	11,524	10,558
Below Normal (13%)	6,270	7,660	9,597	6,291	6,316	6,402	2,260	1,625	3,509	10,692	10,123	9,114
Dry (24%)	6,080	6,687	8,287	6,372	5,633	5,167	2,578	2,041	3,255	8,793	4,808	7,151
Critical (15%)	5,104	4,916	6,238	5,672	4,467	2,915	1,558	1,465	1,083	3,621	2,869	4,060

Alternative 3												
Statistic	Monthly Export Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	11,280	11,280	11,683	10,617	13,018	11,734	9,192	9,155	11,208	11,289	11,280	11,280
20%	10,943	11,280	11,237	9,194	10,692	10,122	8,575	8,070	7,741	11,280	11,280	11,280
30%	10,200	10,959	10,215	7,153	9,440	9,388	7,808	7,344	6,712	11,280	11,280	11,280
40%	8,979	10,530	9,478	6,871	8,078	8,658	7,349	6,270	6,269	11,065	11,280	11,044
50%	7,738	9,599	8,885	6,684	7,085	7,475	6,203	5,343	5,964	10,221	10,153	10,755
60%	6,211	8,419	8,500	6,416	6,557	5,707	5,374	4,562	5,684	9,204	8,172	9,621
70%	5,232	7,840	8,213	6,136	5,700	5,140	4,288	3,738	5,232	7,285	6,446	7,012
80%	4,310	5,809	7,790	5,334	4,623	4,679	3,138	2,021	4,227	6,212	4,356	5,780
90%	3,539	4,644	6,148	4,944	3,641	2,584	2,083	1,654	2,317	3,087	2,763	3,830
Long Term												
Full Simulation Period ^b	7,566	8,739	8,934	7,195	7,616	7,239	5,932	5,370	6,087	8,671	8,335	8,884
Water Year Types^c												
Wet (32%)	8,853	10,333	9,769	9,084	10,641	9,584	8,298	7,973	8,726	10,540	10,840	10,996
Above Normal (16%)	6,987	8,959	9,342	6,729	8,362	9,199	7,419	6,714	6,667	9,523	11,061	10,878
Below Normal (13%)	8,517	9,873	9,875	6,415	6,652	7,278	5,247	4,331	5,550	11,113	10,568	9,877
Dry (24%)	7,156	7,923	8,512	6,325	5,613	5,481	4,543	3,929	4,900	8,000	5,172	7,156
Critical (15%)	5,214	5,369	6,525	5,770	4,472	2,927	2,139	1,626	2,210	2,576	3,183	4,118

Alternative 3 minus No Action Alternative												
Statistic	Monthly Export Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,868	0	-42	801	2,094	762	5,119	5,249	2,658	-316	-500	0
20%	3,553	1,664	-424	1,221	1,163	84	5,526	5,616	1,709	-232	-500	122
30%	3,135	2,911	-927	209	1,381	1,118	5,154	5,271	1,005	0	-350	339
40%	2,476	3,082	405	57	772	862	5,029	4,580	926	224	-220	576
50%	1,727	2,619	843	87	378	581	4,046	3,768	1,717	-92	-1,105	608
60%	742	2,009	749	-25	61	35	3,347	3,062	2,200	-353	-262	1,074
70%	191	2,006	830	6	-145	66	2,389	2,238	2,001	-871	407	121
80%	-343	739	1,620	117	-12	72	1,387	521	1,699	-1,013	449	149
90%	-529	429	693	399	678	-8	583	154	1,597	-681	472	-260
Long Term												
Full Simulation Period ^b	1,410	1,514	356	274	559	352	3,339	3,099	1,452	-400	-140	248
Water Year Types^c												
Wet (32%)	2,179	1,983	602	738	1,025	-72	4,874	4,602	1,246	-335	-824	269
Above Normal (16%)	879	1,391	197	131	1,220	1,126	5,226	5,002	1,370	-26	-463	320
Below Normal (13%)	2,248	2,213	277	123	336	876	2,987	2,706	2,042	422	445	763
Dry (24%)	1,076	1,236	225	-47	-20	314	1,965	1,888	1,645	-792	363	5
Critical (15%)	110	453	287	98	5	12	581	161	1,127	-1,045	313	58

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-18-1-3. Exports Through Jones and Banks Pumping Plants, Monthly Export Rate

No Action Alternative												
Statistic	Monthly Export Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	8,412	11,280	11,725	9,816	10,924	10,973	4,073	3,906	8,550	11,605	11,780	11,280
20%	7,390	9,616	11,661	7,974	9,529	10,037	3,049	2,454	6,033	11,512	11,780	11,158
30%	7,065	8,047	11,142	6,944	8,059	8,270	2,653	2,073	5,707	11,280	11,630	10,941
40%	6,502	7,448	9,074	6,813	7,307	7,796	2,320	1,690	5,343	10,841	11,500	10,468
50%	6,011	6,980	8,042	6,597	6,707	6,893	2,157	1,575	4,248	10,312	11,257	10,146
60%	5,469	6,409	7,751	6,440	6,495	5,672	2,027	1,500	3,484	9,557	8,434	8,546
70%	5,041	5,834	7,383	6,130	5,846	5,073	1,898	1,500	3,232	8,156	6,039	6,891
80%	4,653	5,070	6,170	5,217	4,636	4,607	1,752	1,500	2,529	7,224	3,907	5,631
90%	4,068	4,215	5,455	4,546	2,963	2,592	1,500	1,500	720	3,768	2,291	4,090
Long Term												
Full Simulation Period ^b	6,155	7,225	8,578	6,921	7,056	6,887	2,593	2,270	4,634	9,071	8,476	8,636
Water Year Types^c												
Wet (32%)	6,674	8,350	9,168	8,346	9,616	9,656	3,424	3,371	7,479	10,876	11,663	10,727
Above Normal (16%)	6,108	7,568	9,145	6,598	7,142	8,074	2,193	1,712	5,297	9,549	11,524	10,558
Below Normal (13%)	6,270	7,660	9,597	6,291	6,316	6,402	2,260	1,625	3,509	10,692	10,123	9,114
Dry (24%)	6,080	6,687	8,287	6,372	5,633	5,167	2,578	2,041	3,255	8,793	4,808	7,151
Critical (15%)	5,104	4,916	6,238	5,672	4,467	2,915	1,558	1,465	1,083	3,621	2,869	4,060
Alternative 5												
Statistic	Monthly Export Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	8,356	11,280	11,719	9,816	11,019	11,008	3,744	3,544	8,550	11,605	11,780	11,280
20%	7,383	9,301	11,661	7,974	9,441	9,947	2,778	2,058	6,031	11,526	11,780	11,128
30%	6,974	8,056	11,147	6,944	8,059	8,592	2,254	1,472	5,707	11,315	11,630	10,883
40%	6,151	7,452	9,074	6,813	7,314	7,796	2,048	1,342	5,347	11,030	11,458	10,513
50%	5,859	6,850	8,073	6,590	6,707	6,893	1,871	1,158	4,221	10,499	11,271	10,056
60%	5,426	6,310	7,828	6,438	6,513	5,672	1,624	817	3,484	9,864	9,291	8,537
70%	5,061	5,838	7,355	6,130	5,822	5,069	1,346	612	3,242	9,231	6,523	6,972
80%	4,703	5,072	6,294	5,196	4,635	4,607	762	378	2,989	7,243	4,528	5,828
90%	3,977	4,203	5,478	4,546	2,963	2,592	510	120	710	4,400	3,124	4,271
Long Term												
Full Simulation Period ^b	6,116	7,178	8,583	6,939	7,045	6,883	2,057	1,609	4,684	9,266	8,748	8,643
Water Year Types^c												
Wet (32%)	6,634	8,483	9,172	8,352	9,528	9,624	3,389	3,282	7,464	10,853	11,670	10,537
Above Normal (16%)	6,122	7,102	9,132	6,616	7,206	8,071	2,130	1,490	5,293	9,588	11,463	10,502
Below Normal (13%)	6,190	7,658	9,563	6,291	6,399	6,459	1,731	887	3,499	10,782	10,280	9,421
Dry (24%)	6,012	6,621	8,345	6,367	5,626	5,169	1,351	674	3,440	9,384	5,422	7,278
Critical (15%)	5,093	4,920	6,213	5,776	4,448	2,905	564	330	1,157	3,894	3,612	4,085
Alternative 5 minus No Action Alternative												
Statistic	Monthly Export Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-56	0	-6	0	95	36	-329	-362	0	0	0	0
20%	-7	-315	0	0	-88	-91	-271	-396	-2	14	0	-30
30%	-91	9	5	0	0	322	-400	-601	0	35	0	-58
40%	-351	5	0	0	7	0	-272	-349	4	188	-43	44
50%	-152	-130	31	-7	0	0	-286	-417	-27	187	14	-91
60%	-42	-100	77	-2	18	0	-404	-683	0	307	857	-9
70%	21	4	-28	0	-23	-4	-553	-888	11	1,075	484	81
80%	50	2	124	-21	-1	0	-990	-1,122	460	19	622	197
90%	-91	-11	23	0	0	0	-990	-1,380	-9	632	832	181
Long Term												
Full Simulation Period ^b	-39	-47	5	18	-11	-4	-537	-662	49	195	272	7
Water Year Types^c												
Wet (32%)	-40	133	4	5	-89	-31	-35	-88	-15	-22	6	-190
Above Normal (16%)	14	-465	-13	17	64	-3	-63	-222	-4	39	-61	-56
Below Normal (13%)	-79	-2	-35	-1	84	58	-528	-738	-10	90	157	307
Dry (24%)	-68	-66	58	-5	-7	1	-1,226	-1,367	185	591	614	127
Critical (15%)	-10	4	-26	104	-18	-11	-994	-1,135	74	273	743	25

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-18-1-4. Exports Through Jones and Banks Pumping Plants, Monthly Export Rate

Second Basis of Comparison

Statistic	Monthly Export Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	11,280	11,280	12,011	13,065	13,032	11,429	8,841	8,382	9,334	11,280	11,280	11,280
20%	11,055	11,280	11,772	12,511	12,226	9,882	8,461	6,831	7,652	11,280	11,280	11,280
30%	10,198	10,956	11,699	12,155	12,020	9,114	8,015	6,289	7,137	11,065	11,280	11,280
40%	9,001	10,469	11,672	12,056	11,020	8,815	7,182	5,713	6,920	10,154	10,308	11,235
50%	7,952	9,934	11,110	11,874	9,946	8,283	6,552	5,183	6,543	8,966	8,374	10,679
60%	7,037	8,619	9,776	10,334	9,164	7,898	5,392	4,566	6,067	7,712	7,250	9,166
70%	5,177	7,803	8,992	9,187	8,353	7,489	4,337	3,930	5,372	6,565	6,000	7,066
80%	4,433	5,919	8,133	8,123	7,442	6,091	3,152	2,936	2,951	4,873	4,578	5,708
90%	3,405	4,838	6,145	6,367	6,030	4,944	1,825	1,309	2,153	2,596	2,623	3,805
Long Term												
Full Simulation Period ^b	7,660	8,828	9,949	10,376	9,608	7,948	5,893	5,006	5,913	8,036	7,945	8,870
Water Year Types^c												
Wet (32%)	8,927	10,409	11,637	11,774	10,908	8,829	7,999	6,994	7,657	10,279	10,645	11,087
Above Normal (16%)	6,953	8,763	10,418	11,650	10,392	9,269	7,610	5,897	6,980	9,306	10,525	10,937
Below Normal (13%)	8,905	9,999	10,129	10,967	8,862	8,126	5,670	4,939	6,952	10,234	8,407	9,055
Dry (24%)	7,067	7,987	8,879	9,410	9,250	8,016	4,349	3,704	4,602	6,552	5,293	7,354
Critical (15%)	5,530	5,798	7,399	7,037	7,223	4,330	2,248	1,961	2,213	2,260	3,297	4,187

No Action Alternative

Statistic	Monthly Export Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	8,412	11,280	11,725	9,816	10,924	10,973	4,073	3,906	8,550	11,605	11,780	11,280
20%	7,390	9,616	11,661	7,974	9,529	10,037	3,049	2,454	6,033	11,512	11,780	11,158
30%	7,065	8,047	11,142	6,944	8,059	8,270	2,653	2,073	5,707	11,280	11,630	10,941
40%	6,502	7,448	9,074	6,813	7,307	7,796	2,320	1,690	5,343	10,841	11,500	10,468
50%	6,011	6,980	8,042	6,597	6,707	6,893	2,157	1,575	4,248	10,312	11,257	10,146
60%	5,469	6,409	7,751	6,440	6,495	5,672	2,027	1,500	3,484	9,557	8,434	8,546
70%	5,041	5,834	7,383	6,130	5,846	5,073	1,898	1,500	3,232	8,156	6,039	6,891
80%	4,653	5,070	6,170	5,217	4,636	4,607	1,752	1,500	2,529	7,224	3,907	5,631
90%	4,068	4,215	5,455	4,546	2,963	2,592	1,500	1,500	720	3,768	2,291	4,090
Long Term												
Full Simulation Period ^b	6,155	7,225	8,578	6,921	7,056	6,887	2,593	2,270	4,634	9,071	8,476	8,636
Water Year Types^c												
Wet (32%)	6,674	8,350	9,168	8,346	9,616	9,656	3,424	3,371	7,479	10,876	11,663	10,727
Above Normal (16%)	6,108	7,568	9,145	6,598	7,142	8,074	2,193	1,712	5,297	9,549	11,524	10,558
Below Normal (13%)	6,270	7,660	9,597	6,291	6,316	6,402	2,260	1,625	3,509	10,692	10,123	9,114
Dry (24%)	6,080	6,687	8,287	6,372	5,633	5,167	2,578	2,041	3,255	8,793	4,808	7,151
Critical (15%)	5,104	4,916	6,238	5,672	4,467	2,915	1,558	1,465	1,083	3,621	2,869	4,060

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Export Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-2,868	0	-286	-3,249	-2,108	-456	-4,767	-4,476	-784	325	500	0
20%	-3,665	-1,664	-111	-4,538	-2,696	155	-5,412	-4,377	-1,619	232	500	-122
30%	-3,133	-2,909	-557	-5,211	-3,961	-844	-5,362	-4,216	-1,430	215	350	-339
40%	-2,499	-3,022	-2,598	-5,242	-3,713	-1,019	-4,862	-4,023	-1,577	687	1,192	-767
50%	-1,941	-2,954	-3,069	-5,277	-3,239	-1,390	-4,395	-3,608	-2,296	1,346	2,884	-533
60%	-1,569	-2,209	-2,025	-3,894	-2,669	-2,226	-3,365	-3,066	-2,583	1,845	1,184	-620
70%	-136	-1,969	-1,609	-3,057	-2,508	-2,416	-2,439	-2,430	-2,141	1,591	39	-175
80%	220	-849	-1,963	-2,906	-2,806	-1,484	-1,400	-1,436	-422	2,351	-671	-77
90%	663	-623	-690	-1,821	-3,067	-2,352	-325	191	-1,433	1,172	-332	285
Long Term												
Full Simulation Period ^b	-1,505	-1,603	-1,370	-3,456	-2,552	-1,060	-3,300	-2,735	-1,279	1,035	531	-234
Water Year Types^c												
Wet (32%)	-2,253	-2,060	-2,469	-3,428	-1,292	827	-4,575	-3,624	-178	597	1,018	-360
Above Normal (16%)	-845	-1,195	-1,273	-5,052	-3,249	-1,195	-5,417	-4,185	-1,682	243	999	-379
Below Normal (13%)	-2,636	-2,339	-532	-4,676	-2,546	-1,724	-3,410	-3,313	-3,443	457	1,716	59
Dry (24%)	-987	-1,300	-592	-3,038	-3,616	-2,848	-1,771	-1,663	-1,347	2,241	-485	-203
Critical (15%)	-427	-882	-1,161	-1,364	-2,756	-1,415	-690	-497	-1,131	1,361	-427	-127

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-18-1-5. Exports Through Jones and Banks Pumping Plants, Monthly Export Rate

Second Basis of Comparison												
Statistic	Monthly Export Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	11,280	11,280	12,011	13,065	13,032	11,429	8,841	8,382	9,334	11,280	11,280	11,280
20%	11,055	11,280	11,772	12,511	12,226	9,882	8,461	6,831	7,652	11,280	11,280	11,280
30%	10,198	10,956	11,699	12,155	12,020	9,114	8,015	6,289	7,137	11,065	11,280	11,280
40%	9,001	10,469	11,672	12,056	11,020	8,815	7,182	5,713	6,920	10,154	10,308	11,235
50%	7,952	9,934	11,110	11,874	9,946	8,283	6,552	5,183	6,543	8,966	8,374	10,679
60%	7,037	8,619	9,776	10,334	9,164	7,898	5,392	4,566	6,067	7,712	7,250	9,166
70%	5,177	7,803	8,992	9,187	8,353	7,489	4,337	3,930	5,372	6,565	6,000	7,066
80%	4,433	5,919	8,133	8,123	7,442	6,091	3,152	2,936	2,951	4,873	4,578	5,708
90%	3,405	4,838	6,145	6,367	6,030	4,944	1,825	1,309	2,153	2,596	2,623	3,805
Long Term												
Full Simulation Period ^b	7,660	8,828	9,949	10,376	9,608	7,948	5,893	5,006	5,913	8,036	7,945	8,870
Water Year Types^c												
Wet (32%)	8,927	10,409	11,637	11,774	10,908	8,829	7,999	6,994	7,657	10,279	10,645	11,087
Above Normal (16%)	6,953	8,763	10,418	11,650	10,392	9,269	7,610	5,897	6,980	9,306	10,525	10,937
Below Normal (13%)	8,905	9,999	10,129	10,967	8,862	8,126	5,670	4,939	6,952	10,234	8,407	9,055
Dry (24%)	7,067	7,987	8,879	9,410	9,250	8,016	4,349	3,704	4,602	6,552	5,293	7,354
Critical (15%)	5,530	5,798	7,399	7,037	7,223	4,330	2,248	1,961	2,213	2,260	3,297	4,187
Alternative 3												
Statistic	Monthly Export Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	11,280	11,280	11,683	10,617	13,018	11,734	9,192	9,155	11,208	11,289	11,280	11,280
20%	10,943	11,280	11,237	9,194	10,692	10,122	8,575	8,070	7,741	11,280	11,280	11,280
30%	10,200	10,959	10,215	7,153	9,440	9,388	7,808	7,344	6,712	11,280	11,280	11,280
40%	8,979	10,530	9,478	6,871	8,078	8,658	7,349	6,270	6,269	11,065	11,280	11,044
50%	7,738	9,599	8,885	6,684	7,085	7,475	6,203	5,343	5,964	10,221	10,153	10,755
60%	6,211	8,419	8,500	6,416	6,557	5,707	5,374	4,562	5,684	9,204	8,172	9,621
70%	5,232	7,840	8,213	6,136	5,700	5,140	4,288	3,738	5,232	7,285	6,446	7,012
80%	4,310	5,809	7,790	5,334	4,623	4,679	3,138	2,021	4,227	6,212	4,356	5,780
90%	3,539	4,644	6,148	4,944	3,641	2,584	2,083	1,654	2,317	3,087	2,763	3,830
Long Term												
Full Simulation Period ^b	7,566	8,739	8,934	7,195	7,616	7,239	5,932	5,370	6,087	8,671	8,335	8,884
Water Year Types^c												
Wet (32%)	8,853	10,333	9,769	9,084	10,641	9,584	8,298	7,973	8,726	10,540	10,840	10,996
Above Normal (16%)	6,987	8,959	9,342	6,729	8,362	9,199	7,419	6,714	6,667	9,523	11,061	10,878
Below Normal (13%)	8,517	9,873	9,875	6,415	6,652	7,278	5,247	4,331	5,550	11,113	10,568	9,877
Dry (24%)	7,156	7,923	8,512	6,325	5,613	5,481	4,543	3,929	4,900	8,000	5,172	7,156
Critical (15%)	5,214	5,369	6,525	5,770	4,472	2,927	2,139	1,626	2,210	2,576	3,183	4,118
Alternative 3 minus Second Basis of Comparison												
Statistic	Monthly Export Rate (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	-328	-2,448	-15	306	351	772	1,874	9	0	0
20%	-112	0	-535	-3,317	-1,534	239	114	1,239	90	0	0	0
30%	2	2	-1,484	-5,001	-2,579	274	-208	1,055	-425	215	0	0
40%	-22	60	-2,193	-5,185	-2,941	-158	167	557	-652	911	972	-191
50%	-214	-335	-2,225	-5,190	-2,861	-809	-349	160	-579	1,255	1,779	76
60%	-826	-200	-1,276	-3,918	-2,607	-2,191	-18	-4	-383	1,492	922	454
70%	55	37	-779	-3,051	-2,653	-2,350	-49	-191	-140	720	447	-54
80%	-123	-110	-343	-2,789	-2,818	-1,412	-13	-915	1,277	1,339	-222	71
90%	134	-194	3	-1,422	-2,389	-2,361	257	346	164	490	140	25
Long Term												
Full Simulation Period ^b	-95	-89	-1,014	-3,181	-1,992	-709	39	364	173	635	390	14
Water Year Types^c												
Wet (32%)	-74	-77	-1,867	-2,690	-266	755	300	978	1,069	262	195	-91
Above Normal (16%)	34	196	-1,076	-4,921	-2,029	-69	-191	817	-313	217	536	-59
Below Normal (13%)	-388	-126	-254	-4,552	-2,210	-848	-423	-608	-1,402	879	2,160	822
Dry (24%)	89	-64	-367	-3,084	-3,637	-2,535	194	225	298	1,449	-121	-198
Critical (15%)	-316	-429	-874	-1,266	-2,751	-1,403	-109	-336	-4	316	-114	-70
^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.												
^b Based on the 82-year simulation period.												
^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.												
Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.												

Table C-18-1-6. Exports Through Jones and Banks Pumping Plants, Monthly Export Rate

Second Basis of Comparison		Monthly Export Rate (cfs)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
10%	11,280	11,280	12,011	13,065	13,032	11,429	8,841	8,382	9,334	11,280	11,280	11,280	
20%	11,055	11,280	11,772	12,511	12,226	9,882	8,461	6,831	7,652	11,280	11,280	11,280	
30%	10,198	10,956	11,699	12,155	12,020	9,114	8,015	6,289	7,137	11,065	11,280	11,280	
40%	9,001	10,469	11,672	12,056	11,020	8,815	7,182	5,713	6,920	10,154	10,308	11,235	
50%	7,952	9,934	11,110	11,874	9,946	8,283	6,552	5,183	6,543	8,966	8,374	10,679	
60%	7,037	8,619	9,776	10,334	9,164	7,898	5,392	4,566	6,067	7,712	7,250	9,166	
70%	5,177	7,803	8,992	9,187	8,353	7,489	4,337	3,930	5,372	6,565	6,000	7,066	
80%	4,433	5,919	8,133	8,123	7,442	6,091	3,152	2,936	2,951	4,873	4,578	5,708	
90%	3,405	4,838	6,145	6,367	6,030	4,944	1,825	1,309	2,153	2,596	2,623	3,805	
Long Term													
Full Simulation Period ^b	7,660	8,828	9,949	10,376	9,608	7,948	5,893	5,006	5,913	8,036	7,945	8,870	
Water Year Types ^c													
Wet (32%)	8,927	10,409	11,637	11,774	10,908	8,829	7,999	6,994	7,657	10,279	10,645	11,087	
Above Normal (16%)	6,953	8,763	10,418	11,650	10,392	9,269	7,610	5,897	6,980	9,306	10,525	10,937	
Below Normal (13%)	8,905	9,999	10,129	10,967	8,862	8,126	5,670	4,939	6,952	10,234	8,407	9,055	
Dry (24%)	7,067	7,987	8,879	9,410	9,250	8,016	4,349	3,704	4,602	6,552	5,293	7,354	
Critical (15%)	5,530	5,798	7,399	7,037	7,223	4,330	2,248	1,961	2,213	2,260	3,297	4,187	

Alternative 5

Alternative 5		Monthly Export Rate (cfs)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
10%	8,356	11,280	11,719	9,816	11,019	11,008	3,744	3,544	8,550	11,605	11,780	11,280	
20%	7,383	9,301	11,661	7,974	9,441	9,947	2,778	2,058	6,031	11,526	11,780	11,128	
30%	6,974	8,056	11,147	6,944	8,059	8,592	2,254	1,472	5,707	11,315	11,630	10,883	
40%	6,151	7,452	9,074	6,813	7,314	7,796	2,048	1,342	5,347	11,030	11,458	10,513	
50%	5,859	6,850	8,073	6,590	6,707	6,893	1,871	1,158	4,221	10,499	11,271	10,056	
60%	5,426	6,310	7,828	6,438	6,513	5,672	1,624	817	3,484	9,864	9,291	8,537	
70%	5,061	5,838	7,355	6,130	5,822	5,069	1,346	612	3,242	9,231	6,523	6,972	
80%	4,703	5,072	6,294	5,196	4,635	4,607	762	378	2,989	7,243	4,528	5,828	
90%	3,977	4,203	5,478	4,546	2,963	2,592	510	120	710	4,400	3,124	4,271	
Long Term													
Full Simulation Period ^b	6,116	7,178	8,583	6,939	7,045	6,883	2,057	1,609	4,684	9,266	8,748	8,643	
Water Year Types ^c													
Wet (32%)	6,634	8,483	9,172	8,352	9,528	9,624	3,389	3,282	7,464	10,853	11,670	10,537	
Above Normal (16%)	6,122	7,102	9,132	6,616	7,206	8,071	2,130	1,490	5,293	9,588	11,463	10,502	
Below Normal (13%)	6,190	7,658	9,563	6,291	6,399	6,459	1,731	887	3,499	10,782	10,280	9,421	
Dry (24%)	6,012	6,621	8,345	6,367	5,626	5,169	1,351	674	3,440	9,384	5,422	7,278	
Critical (15%)	5,093	4,920	6,213	5,776	4,448	2,905	564	330	1,157	3,894	3,612	4,085	

Alternative 5 minus Second Basis of Comparison

Alternative 5 minus Second Basis of Comparison		Monthly Export Rate (cfs)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
10%	-2,924	0	-292	-3,249	-2,013	-420	-5,097	-4,838	-784	325	500	0	
20%	-3,672	-1,979	-111	-4,538	-2,784	64	-5,683	-4,773	-1,621	246	500	-152	
30%	-3,224	-2,900	-553	-5,211	-3,961	-522	-5,762	-4,817	-1,430	251	350	-397	
40%	-2,850	-3,017	-2,598	-5,242	-3,706	-1,019	-5,134	-4,371	-1,574	876	1,149	-722	
50%	-2,093	-3,084	-3,037	-5,284	-3,239	-1,390	-4,681	-4,025	-2,322	1,533	2,898	-623	
60%	-1,611	-2,309	-1,948	-3,896	-2,651	-2,227	-3,768	-3,749	-2,583	2,152	2,041	-629	
70%	-115	-1,965	-1,637	-3,057	-2,531	-2,420	-2,992	-3,318	-2,130	2,666	523	-94	
80%	270	-848	-1,839	-2,927	-2,807	-1,483	-2,390	-2,558	39	2,371	-49	120	
90%	572	-634	-667	-1,821	-3,067	-2,352	-1,315	-1,189	-1,443	1,804	500	466	
Long Term													
Full Simulation Period ^b	-1,544	-1,650	-1,365	-3,437	-2,563	-1,064	-3,836	-3,397	-1,230	1,230	803	-228	
Water Year Types ^c													
Wet (32%)	-2,293	-1,927	-2,465	-3,423	-1,380	796	-4,610	-3,712	-193	574	1,025	-550	
Above Normal (16%)	-832	-1,661	-1,286	-5,035	-3,185	-1,198	-5,481	-4,407	-1,687	282	938	-435	
Below Normal (13%)	-2,715	-2,341	-567	-4,676	-2,463	-1,667	-3,939	-4,052	-3,453	548	1,873	366	
Dry (24%)	-1,055	-1,366	-534	-3,042	-3,623	-2,847	-2,998	-3,030	-1,162	2,832	129	-76	
Critical (15%)	-437	-878	-1,187	-1,260	-2,775	-1,425	-1,684	-1,631	-1,056	1,635	316	-103	

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-18-2-1. Exports Through Jones and Banks Pumping Plants, Monthly Export Volume

No Action Alternative												
Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	517	671	721	604	611	675	242	240	509	714	724	671
20%	454	572	717	490	532	617	181	151	359	708	724	664
30%	434	479	685	427	448	508	158	127	340	694	715	651
40%	400	443	558	419	409	479	138	104	318	667	707	623
50%	370	415	494	406	380	424	128	97	253	634	692	604
60%	336	381	477	396	363	349	121	92	207	588	519	509
70%	310	347	454	377	325	312	113	92	192	501	371	410
80%	286	302	379	321	267	283	104	92	150	444	240	335
90%	250	251	335	280	165	159	89	92	43	232	141	243
Long Term												
Full Simulation Period ^b	378	430	527	426	395	423	154	140	276	558	521	514
Water Year Types^c												
Wet (32%)	410	497	564	513	537	594	204	207	445	669	717	638
Above Normal (16%)	376	450	562	406	401	496	130	105	315	587	709	628
Below Normal (13%)	386	456	590	387	354	394	134	100	209	657	622	542
Dry (24%)	374	398	510	392	315	318	153	126	194	541	296	426
Critical (15%)	314	293	384	349	250	179	93	90	64	223	176	242

Alternative 1												
Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	694	671	739	803	727	703	526	515	555	694	694	671
20%	680	671	724	769	686	608	503	420	455	694	694	671
30%	627	652	719	747	668	560	477	387	425	680	694	671
40%	553	623	718	741	614	542	427	351	412	624	634	669
50%	489	591	683	730	552	509	390	319	389	551	515	635
60%	433	513	601	635	519	486	321	281	361	474	446	545
70%	318	464	553	565	465	461	258	242	320	404	369	420
80%	273	352	500	499	416	374	188	181	176	300	281	340
90%	209	288	378	391	335	304	109	80	128	160	161	226
Long Term												
Full Simulation Period ^b	471	525	612	638	538	489	351	308	352	494	489	528
Water Year Types^c												
Wet (32%)	549	619	716	724	609	543	476	430	456	632	655	660
Above Normal (16%)	428	521	641	716	584	570	453	363	415	572	647	651
Below Normal (13%)	548	595	623	674	497	500	337	304	414	629	517	539
Dry (24%)	435	475	546	579	518	493	259	228	274	403	325	438
Critical (15%)	340	345	455	433	406	266	134	121	132	139	203	249

Alternative 1 minus No Action Alternative												
Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	176	0	18	200	116	28	284	275	47	-20	-31	0
20%	225	99	7	279	154	-10	322	269	96	-14	-31	7
30%	193	173	34	320	220	52	319	259	85	-13	-22	20
40%	154	180	160	322	205	63	289	247	94	-42	-73	46
50%	119	176	189	324	172	85	262	222	137	-83	-177	32
60%	96	131	125	239	156	137	200	189	154	-113	-73	37
70%	8	117	99	188	140	149	145	149	127	-98	-2	10
80%	-14	51	121	179	150	91	83	88	25	-145	41	5
90%	-41	37	42	112	170	145	19	-12	85	-72	20	-17
Long Term												
Full Simulation Period ^b	93	95	84	212	143	65	196	168	76	-64	-33	14
Water Year Types^c												
Wet (32%)	139	123	152	211	72	-51	272	223	11	-37	-63	21
Above Normal (16%)	52	71	78	311	183	73	322	257	100	-15	-61	23
Below Normal (13%)	162	139	33	287	143	106	203	204	205	-28	-105	-4
Dry (24%)	61	77	36	187	202	175	105	102	80	-138	30	12
Critical (15%)	26	52	71	84	156	87	41	31	67	-84	26	8

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-18-2.2. Exports Through Jones and Banks Pumping Plants, Monthly Export Volume

No Action Alternative												
Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	517	671	721	604	611	675	242	240	509	714	724	671
20%	454	572	717	490	532	617	181	151	359	708	724	664
30%	434	479	685	427	448	508	158	127	340	694	715	651
40%	400	443	558	419	409	479	138	104	318	667	707	623
50%	370	415	494	406	380	424	128	97	253	634	692	604
60%	336	381	477	396	363	349	121	92	207	588	519	509
70%	310	347	454	377	325	312	113	92	192	501	371	410
80%	286	302	379	321	267	283	104	92	150	444	240	335
90%	250	251	335	280	165	159	89	92	43	232	141	243
Long Term												
Full Simulation Period ^b	378	430	527	426	395	423	154	140	276	558	521	514
Water Year Types ^c												
Wet (32%)	410	497	564	513	537	594	204	207	445	669	717	638
Above Normal (16%)	376	450	562	406	401	496	130	105	315	587	709	628
Below Normal (13%)	386	456	590	387	354	394	134	100	209	657	622	542
Dry (24%)	374	398	510	392	315	318	153	126	194	541	296	426
Critical (15%)	314	293	384	349	250	179	93	90	64	223	176	242

Alternative 3												
Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	694	671	718	653	725	722	547	563	667	694	694	671
20%	673	671	691	565	603	622	510	496	461	694	694	671
30%	627	652	628	440	524	577	465	452	399	694	694	671
40%	552	627	583	422	449	532	437	386	373	680	694	657
50%	476	571	546	411	393	460	369	329	355	628	624	640
60%	382	501	523	395	365	351	320	281	338	566	502	572
70%	322	467	505	377	320	316	255	230	311	448	396	417
80%	265	346	479	328	264	288	187	124	252	382	268	344
90%	218	276	378	304	202	159	124	102	138	190	170	228
Long Term												
Full Simulation Period ^b	465	520	549	442	426	445	353	330	362	533	513	529
Water Year Types ^c												
Wet (32%)	544	615	601	559	594	589	494	490	519	648	667	654
Above Normal (16%)	430	533	574	414	469	566	441	413	397	586	680	647
Below Normal (13%)	524	587	607	394	373	448	312	266	330	683	650	588
Dry (24%)	440	471	523	389	314	337	270	242	292	492	318	426
Critical (15%)	321	319	401	355	251	180	127	100	131	158	196	245

Alternative 3 minus No Action Alternative												
Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	176	0	-3	49	114	47	305	323	158	-19	-31	0
20%	218	99	-26	75	71	5	329	345	102	-14	-31	7
30%	193	173	-57	13	77	69	307	324	60	0	-22	20
40%	152	183	25	4	41	53	299	282	55	14	-14	34
50%	106	156	52	5	13	36	241	232	102	-6	-68	36
60%	46	120	46	-2	2	2	199	188	131	-22	-16	64
70%	12	119	51	0	-5	4	142	138	119	-54	25	7
80%	-21	44	100	7	-3	4	83	32	101	-62	28	9
90%	-33	26	43	25	38	-1	35	9	95	-42	29	-15
Long Term												
Full Simulation Period ^b	87	90	22	17	31	22	199	191	86	-25	-9	15
Water Year Types ^c												
Wet (32%)	134	118	37	45	57	-4	290	283	74	-21	-51	16
Above Normal (16%)	54	83	12	8	68	69	311	308	81	-2	-28	19
Below Normal (13%)	138	132	17	8	19	54	178	166	121	26	27	45
Dry (24%)	66	74	14	-3	-1	19	117	116	98	-49	22	0
Critical (15%)	7	27	18	6	0	1	35	10	67	-64	19	3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-18-2.3. Exports Through Jones and Banks Pumping Plants, Monthly Export Volume

No Action Alternative												
Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	517	671	721	604	611	675	242	240	509	714	724	671
20%	454	572	717	490	532	617	181	151	359	708	724	664
30%	434	479	685	427	448	508	158	127	340	694	715	651
40%	400	443	558	419	409	479	138	104	318	667	707	623
50%	370	415	494	406	380	424	128	97	253	634	692	604
60%	336	381	477	396	363	349	121	92	207	588	519	509
70%	310	347	454	377	325	312	113	92	192	501	371	410
80%	286	302	379	321	267	283	104	92	150	444	240	335
90%	250	251	335	280	165	159	89	92	43	232	141	243
Long Term												
Full Simulation Period ^b	378	430	527	426	395	423	154	140	276	558	521	514
Water Year Types ^c												
Wet (32%)	410	497	564	513	537	594	204	207	445	669	717	638
Above Normal (16%)	376	450	562	406	401	496	130	105	315	587	709	628
Below Normal (13%)	386	456	590	387	354	394	134	100	209	657	622	542
Dry (24%)	374	398	510	392	315	318	153	126	194	541	296	426
Critical (15%)	314	293	384	349	250	179	93	90	64	223	176	242

Alternative 5												
Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	514	671	721	604	613	677	223	218	509	714	724	671
20%	454	553	717	490	528	612	165	127	359	709	724	662
30%	429	479	685	427	448	528	134	91	340	696	715	648
40%	378	443	558	419	416	479	122	83	318	678	705	626
50%	360	408	496	405	380	424	111	71	251	646	693	598
60%	334	375	481	396	363	349	97	50	207	606	571	508
70%	311	347	452	377	323	312	80	38	193	568	401	415
80%	289	302	387	319	267	283	45	23	178	445	278	347
90%	245	250	337	280	165	159	30	7	42	271	192	254
Long Term												
Full Simulation Period ^b	376	427	528	427	394	423	122	99	279	570	538	514
Water Year Types ^c												
Wet (32%)	408	505	564	514	532	592	202	202	444	667	718	627
Above Normal (16%)	376	423	561	407	405	496	127	92	315	590	705	625
Below Normal (13%)	381	456	588	387	359	397	103	55	208	663	632	561
Dry (24%)	370	394	513	392	315	318	80	41	205	577	333	433
Critical (15%)	313	293	382	355	249	179	34	20	69	239	222	243

Alternative 5 minus No Action Alternative												
Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-3	0	0	0	2	2	-20	-22	0	0	0	0
20%	0	-19	0	0	-4	-6	-16	-24	0	1	0	-2
30%	-6	1	0	0	0	20	-24	-37	0	2	0	-3
40%	-22	0	0	0	8	0	-16	-21	0	12	-3	3
50%	-9	-8	2	0	0	0	-17	-26	-2	11	1	-5
60%	-3	-6	5	0	0	0	-24	-42	0	19	53	-1
70%	1	0	-2	0	-1	0	-33	-55	1	66	30	5
80%	3	0	8	-1	0	0	-59	-69	27	1	38	12
90%	-6	-1	1	0	0	0	-59	-85	-1	39	51	11
Long Term												
Full Simulation Period ^b	-2	-3	0	1	-1	0	-32	-41	3	12	17	0
Water Year Types ^c												
Wet (32%)	-2	8	0	0	-5	-2	-2	-5	-1	-1	0	-11
Above Normal (16%)	1	-28	-1	1	4	0	-4	-14	0	2	-4	-3
Below Normal (13%)	-5	0	-2	0	5	4	-31	-45	-1	6	10	18
Dry (24%)	-4	-4	4	0	0	0	-73	-84	11	36	38	8
Critical (15%)	-1	0	-2	6	-1	-1	-59	-70	4	17	46	1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-18-2-4. Exports Through Jones and Banks Pumping Plants, Monthly Export Volume

Second Basis of Comparison

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	694	671	739	803	727	703	526	515	555	694	694	671
20%	680	671	724	769	686	608	503	420	455	694	694	671
30%	627	652	719	747	668	560	477	387	425	680	694	671
40%	553	623	718	741	614	542	427	351	412	624	634	669
50%	489	591	683	730	552	509	390	319	389	551	515	635
60%	433	513	601	635	519	486	321	281	361	474	446	545
70%	318	464	553	565	465	461	258	242	320	404	369	420
80%	273	352	500	499	416	374	188	181	176	300	281	340
90%	209	288	378	391	335	304	109	80	128	160	161	226
Long Term												
Full Simulation Period ^b	471	525	612	638	538	489	351	308	352	494	489	528
Water Year Types^c												
Wet (32%)	549	619	716	724	609	543	476	430	456	632	655	660
Above Normal (16%)	428	521	641	716	584	570	453	363	415	572	647	651
Below Normal (13%)	548	595	623	674	497	500	337	304	414	629	517	539
Dry (24%)	435	475	546	579	518	493	259	228	274	403	325	438
Critical (15%)	340	345	455	433	406	266	134	121	132	139	203	249

No Action Alternative

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	517	671	721	604	611	675	242	240	509	714	724	671
20%	454	572	717	490	532	617	181	151	359	708	724	664
30%	434	479	685	427	448	508	158	127	340	694	715	651
40%	400	443	558	419	409	479	138	104	318	667	707	623
50%	370	415	494	406	380	424	128	97	253	634	692	604
60%	336	381	477	396	363	349	121	92	207	588	519	509
70%	310	347	454	377	325	312	113	92	192	501	371	410
80%	286	302	379	321	267	283	104	92	150	444	240	335
90%	250	251	335	280	165	159	89	92	43	232	141	243
Long Term												
Full Simulation Period ^b	378	430	527	426	395	423	154	140	276	558	521	514
Water Year Types^c												
Wet (32%)	410	497	564	513	537	594	204	207	445	669	717	638
Above Normal (16%)	376	450	562	406	401	496	130	105	315	587	709	628
Below Normal (13%)	386	456	590	387	354	394	134	100	209	657	622	542
Dry (24%)	374	398	510	392	315	318	153	126	194	541	296	426
Critical (15%)	314	293	384	349	250	179	93	90	64	223	176	242

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-176	0	-18	-200	-116	-28	-284	-275	-47	20	31	0
20%	-225	-99	-7	-279	-154	10	-322	-269	-96	14	31	-7
30%	-193	-173	-34	-320	-220	-52	-319	-259	-85	13	22	-20
40%	-154	-180	-160	-322	-205	-63	-289	-247	-94	42	73	-46
50%	-119	-176	-189	-324	-172	-85	-262	-222	-137	83	177	-32
60%	-96	-131	-125	-239	-156	-137	-200	-189	-154	113	73	-37
70%	-8	-117	-99	-188	-140	-149	-145	-149	-127	98	2	-10
80%	14	-51	-121	-179	-150	-91	-83	-88	-25	145	-41	-5
90%	41	-37	-42	-112	-170	-145	-19	12	-85	72	-20	17
Long Term												
Full Simulation Period ^b	-93	-95	-84	-212	-143	-65	-196	-168	-76	64	33	-14
Water Year Types^c												
Wet (32%)	-139	-123	-152	-211	-72	51	-272	-223	-11	37	63	-21
Above Normal (16%)	-52	-71	-78	-311	-183	-73	-322	-257	-100	15	61	-23
Below Normal (13%)	-162	-139	-33	-287	-143	-106	-203	-204	-205	28	105	4
Dry (24%)	-61	-77	-36	-187	-202	-175	-105	-102	-80	138	-30	-12
Critical (15%)	-26	-52	-71	-84	-156	-87	-41	-31	-67	84	-26	-8

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-18-2-5. Exports Through Jones and Banks Pumping Plants, Monthly Export Volume

Second Basis of Comparison

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	694	671	739	803	727	703	526	515	555	694	694	671
20%	680	671	724	769	686	608	503	420	455	694	694	671
30%	627	652	719	747	668	560	477	387	425	680	694	671
40%	553	623	718	741	614	542	427	351	412	624	634	669
50%	489	591	683	730	552	509	390	319	389	551	515	635
60%	433	513	601	635	519	486	321	281	361	474	446	545
70%	318	464	553	565	465	461	258	242	320	404	369	420
80%	273	352	500	499	416	374	188	181	176	300	281	340
90%	209	288	378	391	335	304	109	80	128	160	161	226
Long Term												
Full Simulation Period ^b	471	525	612	638	538	489	351	308	352	494	489	528
Water Year Types ^c												
Wet (32%)	549	619	716	724	609	543	476	430	456	632	655	660
Above Normal (16%)	428	521	641	716	584	570	453	363	415	572	647	651
Below Normal (13%)	548	595	623	674	497	500	337	304	414	629	517	539
Dry (24%)	435	475	546	579	518	493	259	228	274	403	325	438
Critical (15%)	340	345	455	433	406	266	134	121	132	139	203	249

Alternative 3

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	694	671	718	653	725	722	547	563	667	694	694	671
20%	673	671	691	565	603	622	510	496	461	694	694	671
30%	627	652	628	440	524	577	465	452	399	694	694	671
40%	552	627	583	422	449	532	437	386	373	680	694	657
50%	476	571	546	411	393	460	369	329	355	628	624	640
60%	382	501	523	395	365	351	320	281	338	566	502	572
70%	322	467	505	377	320	316	255	230	311	448	396	417
80%	265	346	479	328	264	288	187	124	252	382	268	344
90%	218	276	378	304	202	159	124	102	138	190	170	228
Long Term												
Full Simulation Period ^b	465	520	549	442	426	445	353	330	362	533	513	529
Water Year Types ^c												
Wet (32%)	544	615	601	559	594	589	494	490	519	648	667	654
Above Normal (16%)	430	533	574	414	469	566	441	413	397	586	680	647
Below Normal (13%)	524	587	607	394	373	448	312	266	330	683	650	588
Dry (24%)	440	471	523	389	314	337	270	242	292	492	318	426
Critical (15%)	321	319	401	355	251	180	127	100	131	158	196	245

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0	0	-20	-151	-2	19	21	47	112	1	0	0
20%	-7	0	-33	-204	-83	15	7	76	5	0	0	0
30%	0	0	-91	-308	-143	17	-12	65	-25	13	0	0
40%	-1	4	-135	-319	-165	-10	10	34	-39	56	60	-11
50%	-13	-20	-137	-319	-159	-50	-21	10	-34	77	109	5
60%	-51	-12	-78	-241	-154	-135	-1	0	-23	92	57	27
70%	3	2	-48	-188	-145	-144	-3	-12	-8	44	27	-3
80%	-8	-7	-21	-172	-152	-87	-1	-56	76	82	-14	4
90%	8	-12	0	-87	-133	-145	15	21	10	30	9	1
Long Term												
Full Simulation Period ^b	-6	-5	-62	-196	-112	-44	2	22	10	39	24	1
Water Year Types ^c												
Wet (32%)	-5	-5	-115	-165	-15	46	18	60	64	16	12	-5
Above Normal (16%)	2	12	-66	-303	-115	-4	-11	50	-19	13	33	-3
Below Normal (13%)	-24	-7	-16	-280	-124	-52	-25	-37	-83	54	133	49
Dry (24%)	5	-4	-23	-190	-203	-156	12	14	18	89	-7	-12
Critical (15%)	-19	-26	-54	-78	-156	-86	-6	-21	0	19	-7	-4

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-18-2-6. Exports Through Jones and Banks Pumping Plants, Monthly Export Volume

Second Basis of Comparison

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	694	671	739	803	727	703	526	515	555	694	694	671
20%	680	671	724	769	686	608	503	420	455	694	694	671
30%	627	652	719	747	668	560	477	387	425	680	694	671
40%	553	623	718	741	614	542	427	351	412	624	634	669
50%	489	591	683	730	552	509	390	319	389	551	515	635
60%	433	513	601	635	519	486	321	281	361	474	446	545
70%	318	464	553	565	465	461	258	242	320	404	369	420
80%	273	352	500	499	416	374	188	181	176	300	281	340
90%	209	288	378	391	335	304	109	80	128	160	161	226
Long Term												
Full Simulation Period ^b	471	525	612	638	538	489	351	308	352	494	489	528
Water Year Types ^c												
Wet (32%)	549	619	716	724	609	543	476	430	456	632	655	660
Above Normal (16%)	428	521	641	716	584	570	453	363	415	572	647	651
Below Normal (13%)	548	595	623	674	497	500	337	304	414	629	517	539
Dry (24%)	435	475	546	579	518	493	259	228	274	403	325	438
Critical (15%)	340	345	455	433	406	266	134	121	132	139	203	249

Alternative 5

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	514	671	721	604	613	677	223	218	509	714	724	671
20%	454	553	717	490	528	612	165	127	359	709	724	662
30%	429	479	685	427	448	528	134	91	340	696	715	648
40%	378	443	558	419	416	479	122	83	318	678	705	626
50%	360	408	496	405	380	424	111	71	251	646	693	598
60%	334	375	481	396	363	349	97	50	207	606	571	508
70%	311	347	452	377	323	312	80	38	193	568	401	415
80%	289	302	387	319	267	283	45	23	178	445	278	347
90%	245	250	337	280	165	159	30	7	42	271	192	254
Long Term												
Full Simulation Period ^b	376	427	528	427	394	423	122	99	279	570	538	514
Water Year Types ^c												
Wet (32%)	408	505	564	514	532	592	202	202	444	667	718	627
Above Normal (16%)	376	423	561	407	405	496	127	92	315	590	705	625
Below Normal (13%)	381	456	588	387	359	397	103	55	208	663	632	561
Dry (24%)	370	394	513	392	315	318	80	41	205	577	333	433
Critical (15%)	313	293	382	355	249	179	34	20	69	239	222	243

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-180	0	-18	-200	-114	-26	-303	-298	-47	20	31	0
20%	-226	-118	-7	-279	-158	4	-338	-294	-96	15	31	-9
30%	-198	-173	-34	-320	-220	-32	-343	-296	-85	15	22	-24
40%	-175	-180	-160	-322	-198	-63	-306	-269	-94	54	71	-43
50%	-129	-184	-187	-325	-172	-85	-279	-247	-138	94	178	-37
60%	-99	-137	-120	-240	-156	-137	-224	-230	-154	132	125	-37
70%	-7	-117	-101	-188	-141	-149	-178	-204	-127	164	32	-6
80%	17	-50	-113	-180	-150	-91	-142	-157	2	146	-3	7
90%	35	-38	-41	-112	-170	-145	-78	-73	-86	111	31	28
Long Term												
Full Simulation Period ^b	-95	-98	-84	-211	-144	-65	-228	-209	-73	76	49	-14
Water Year Types ^c												
Wet (32%)	-141	-115	-152	-210	-77	49	-274	-228	-11	35	63	-33
Above Normal (16%)	-51	-99	-79	-310	-179	-74	-326	-271	-100	17	58	-26
Below Normal (13%)	-167	-139	-35	-288	-138	-102	-234	-249	-205	34	115	22
Dry (24%)	-65	-81	-33	-187	-203	-175	-178	-186	-69	174	8	-5
Critical (15%)	-27	-52	-73	-77	-157	-88	-100	-100	-63	101	19	-6

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 **C.19. CVP Deliveries**

Figure C-19-1-1. Annual CVP North of Delta Agricultural Water Service Contract Deliveries

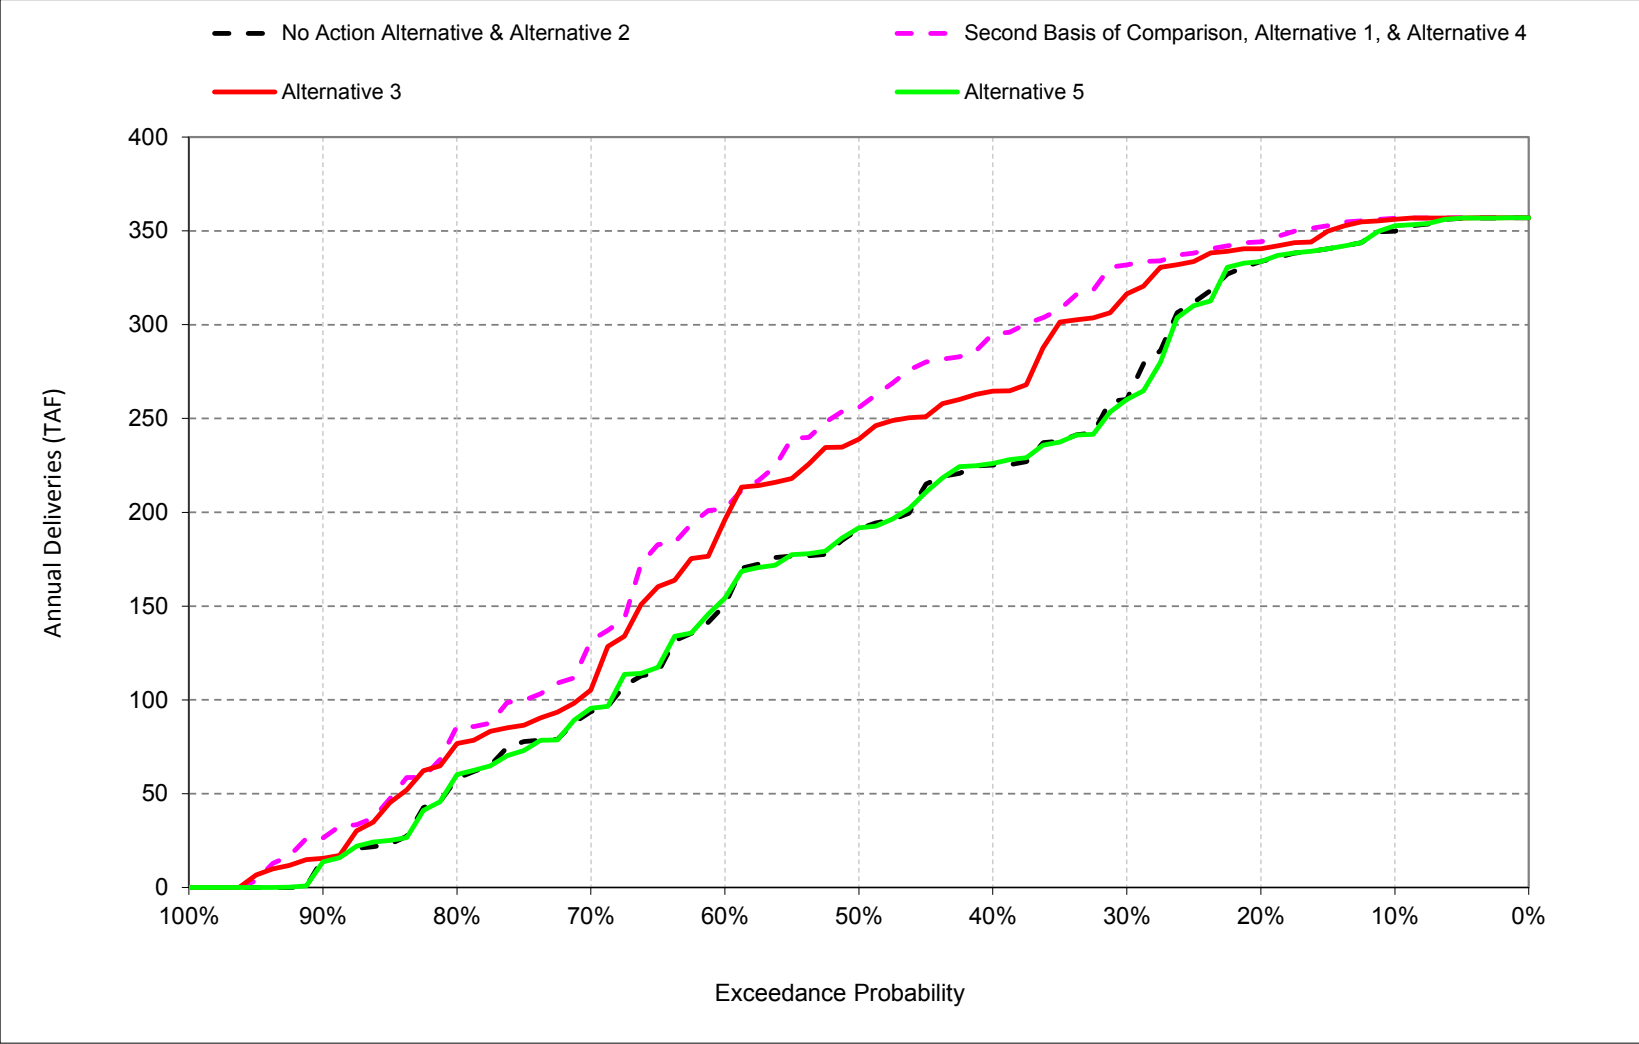


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 5) Annual deliveries are based on March to February Average.

Figure C-19-1-2. Annual CVP South of Delta Agricultural Water Service Contract Deliveries

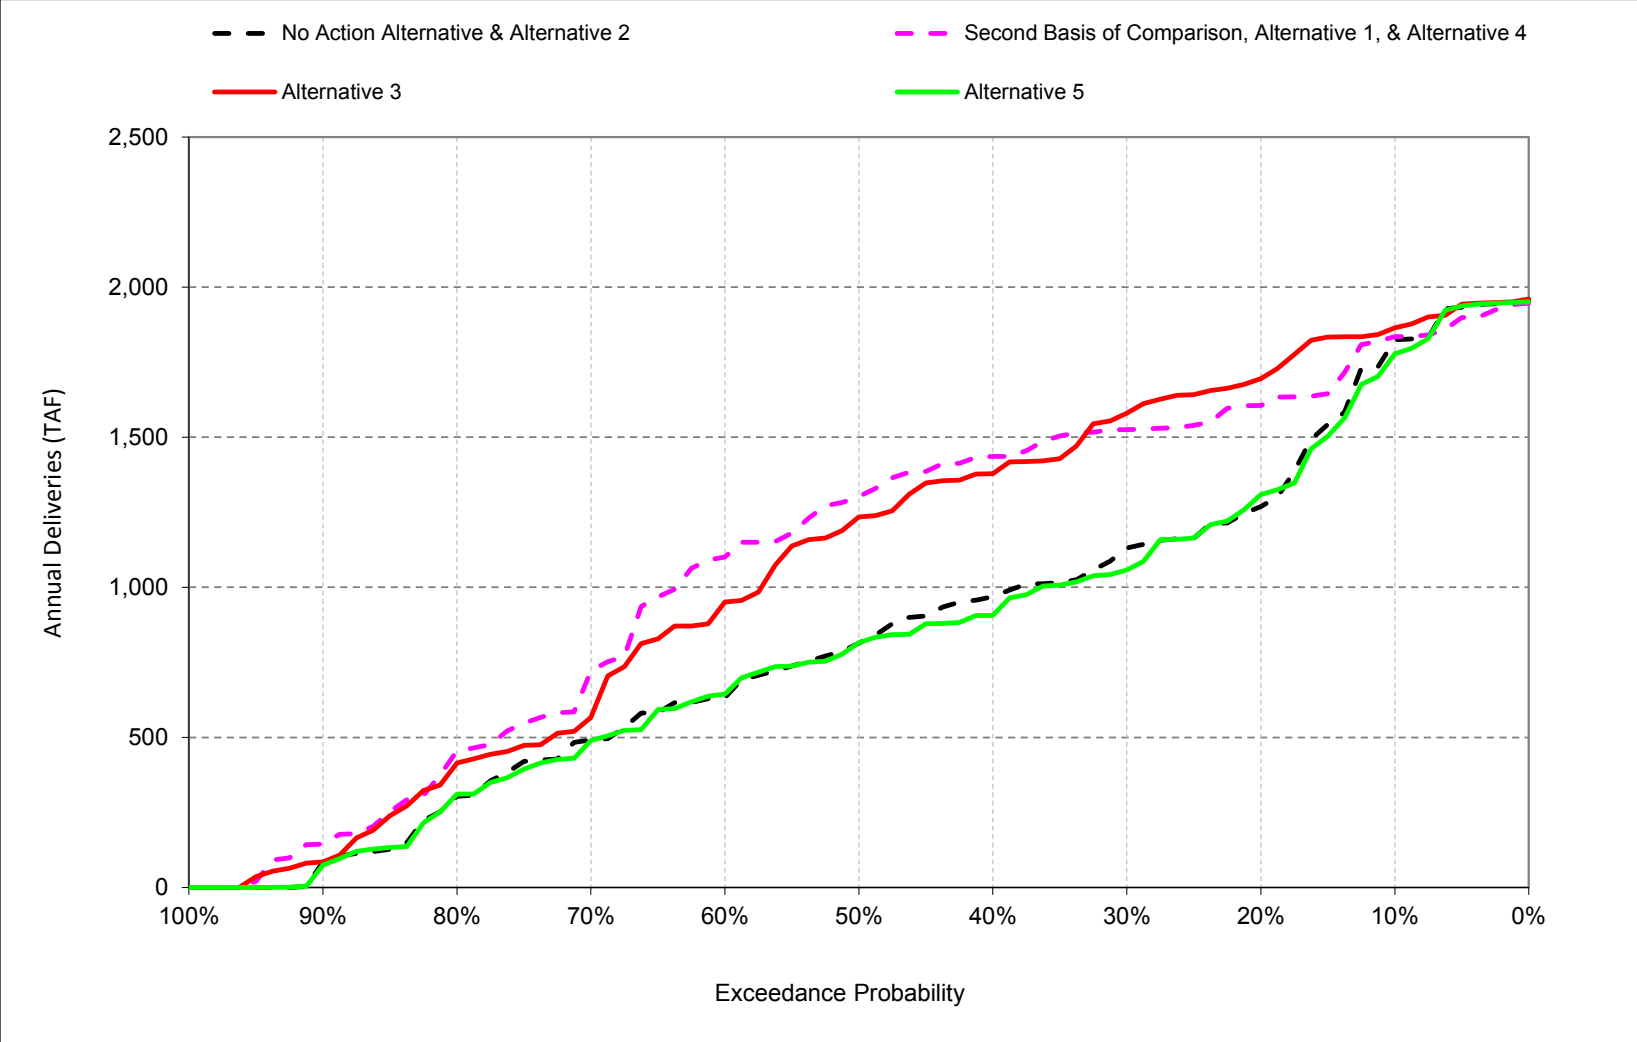


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 5) Does not include Eastside Contractors deliveries. 6) Annual deliveries are based on March to February Average.

Figure C-19-1-3. Annual CVP North of Delta M&I Water Service Contract Deliveries

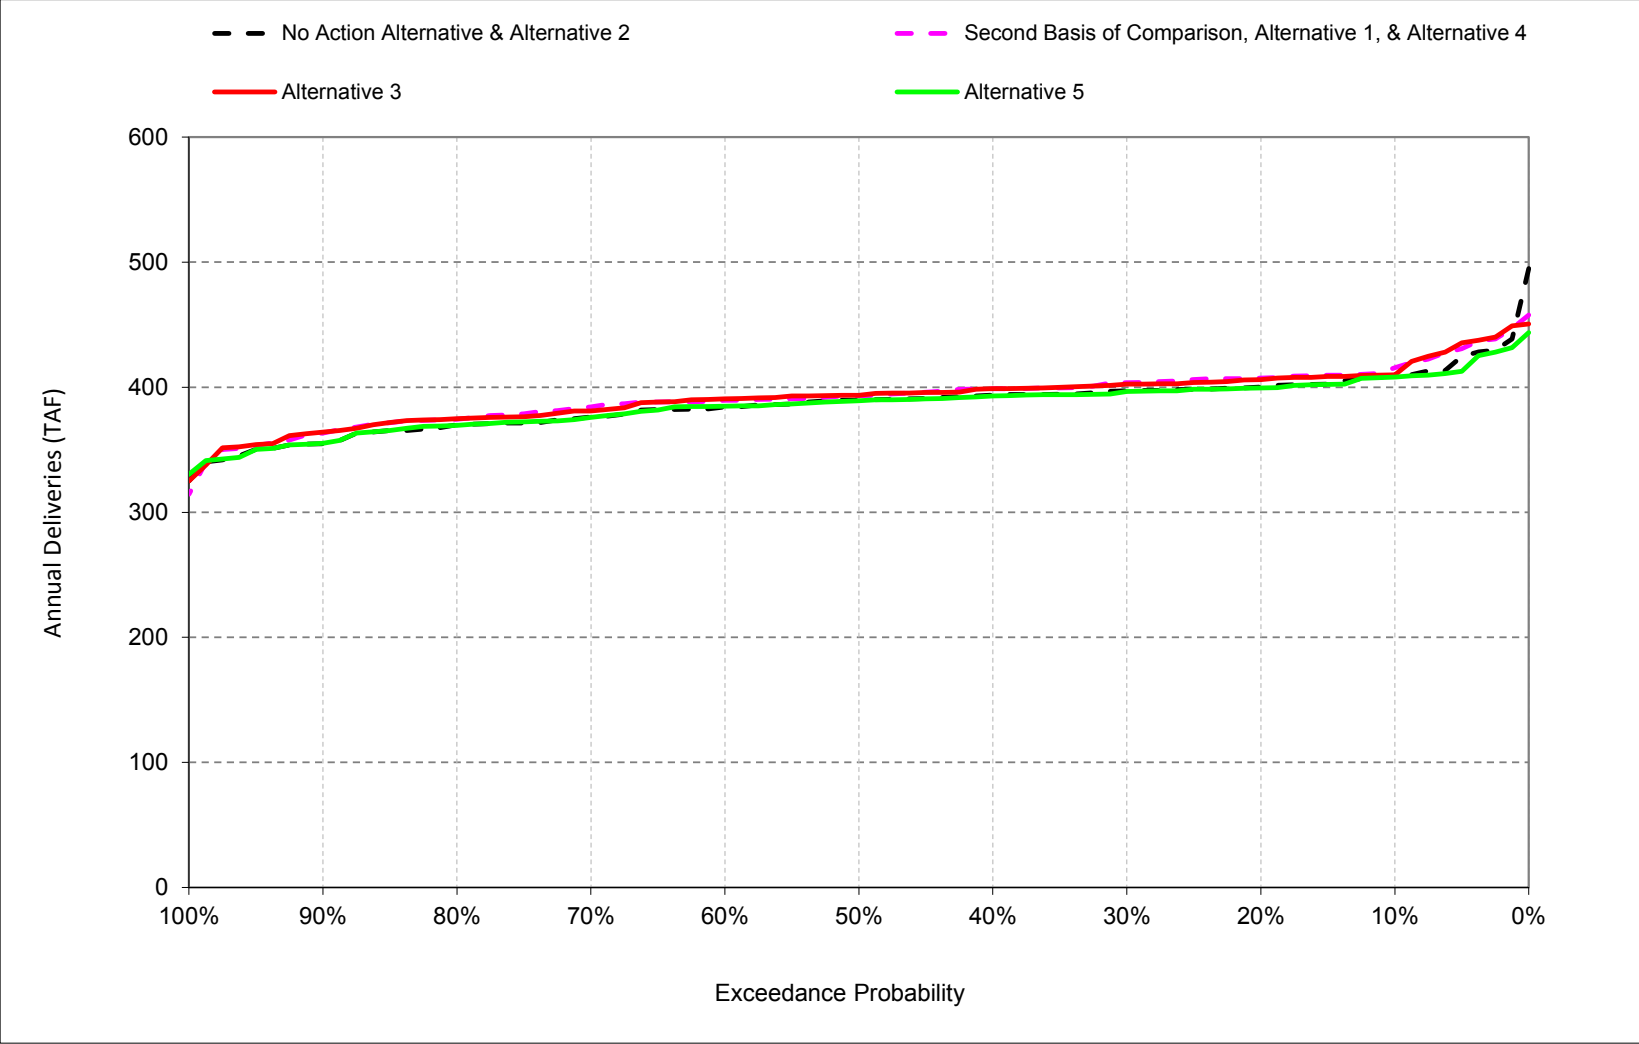


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 6) Annual deliveries are based on March to February Average.

Figure C-19-1-4. Annual CVP American River M&I Water Service Contract Deliveries

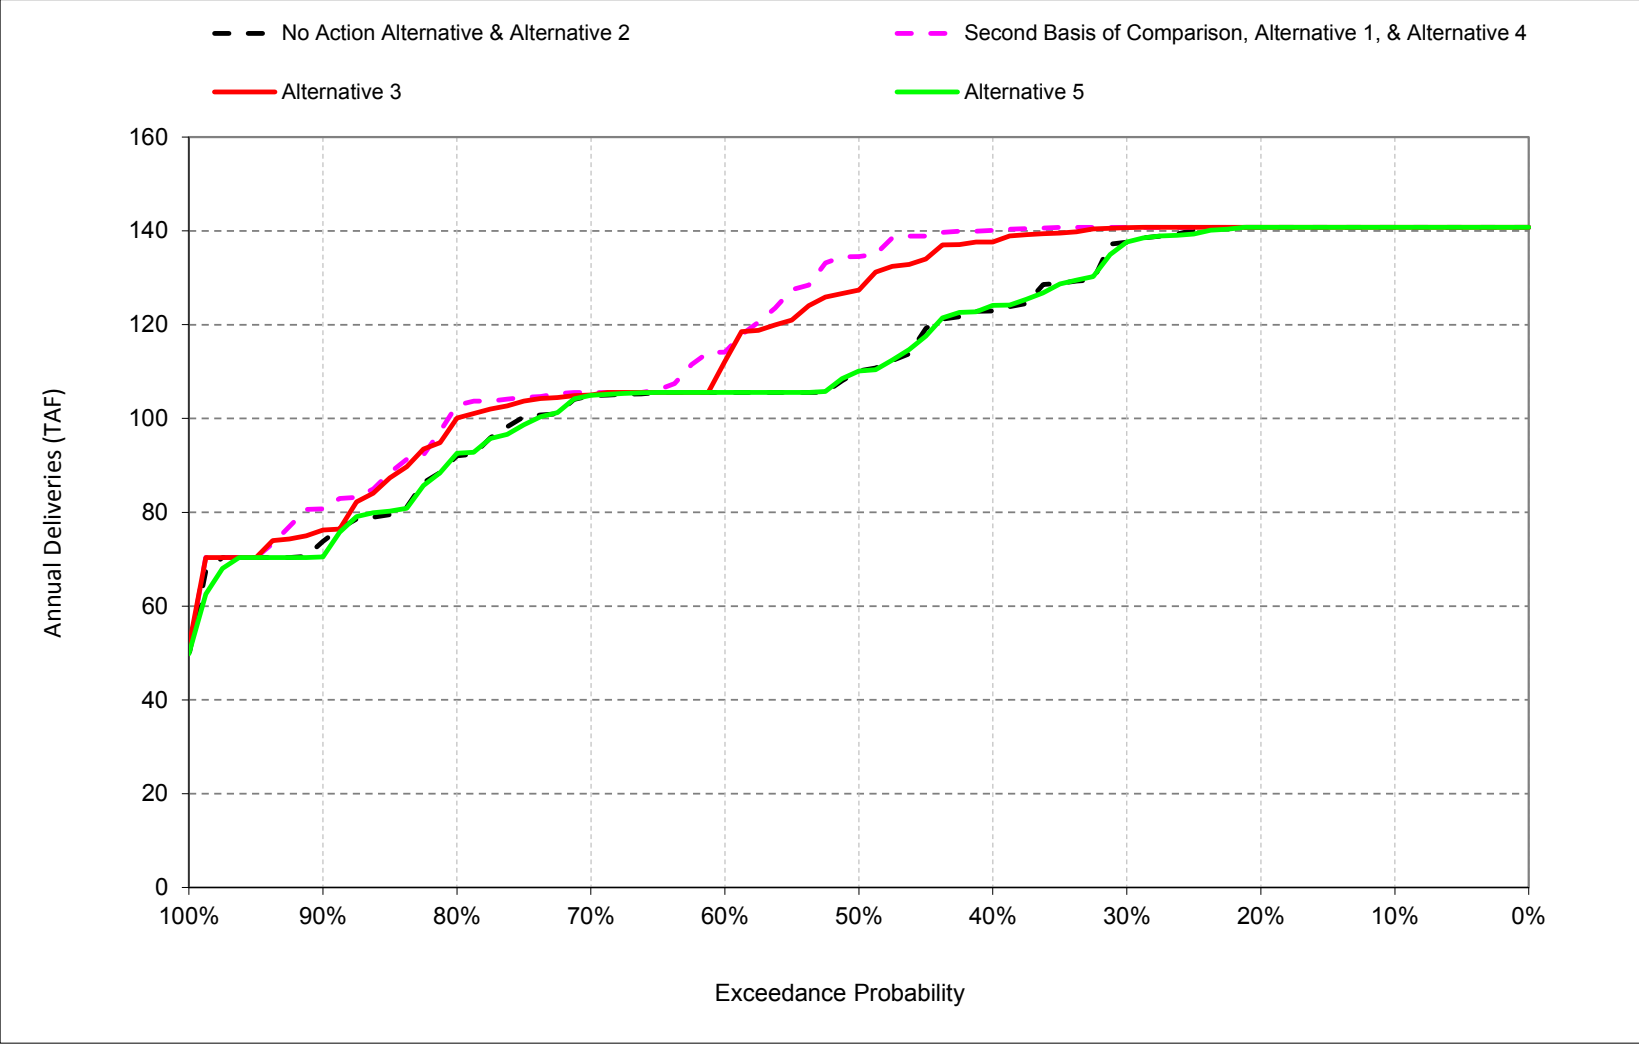


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 5) Annual deliveries are based on March to February Average.

Figure C-19-1-5. Annual CVP South of Delta M&I Water Service Contract Deliveries

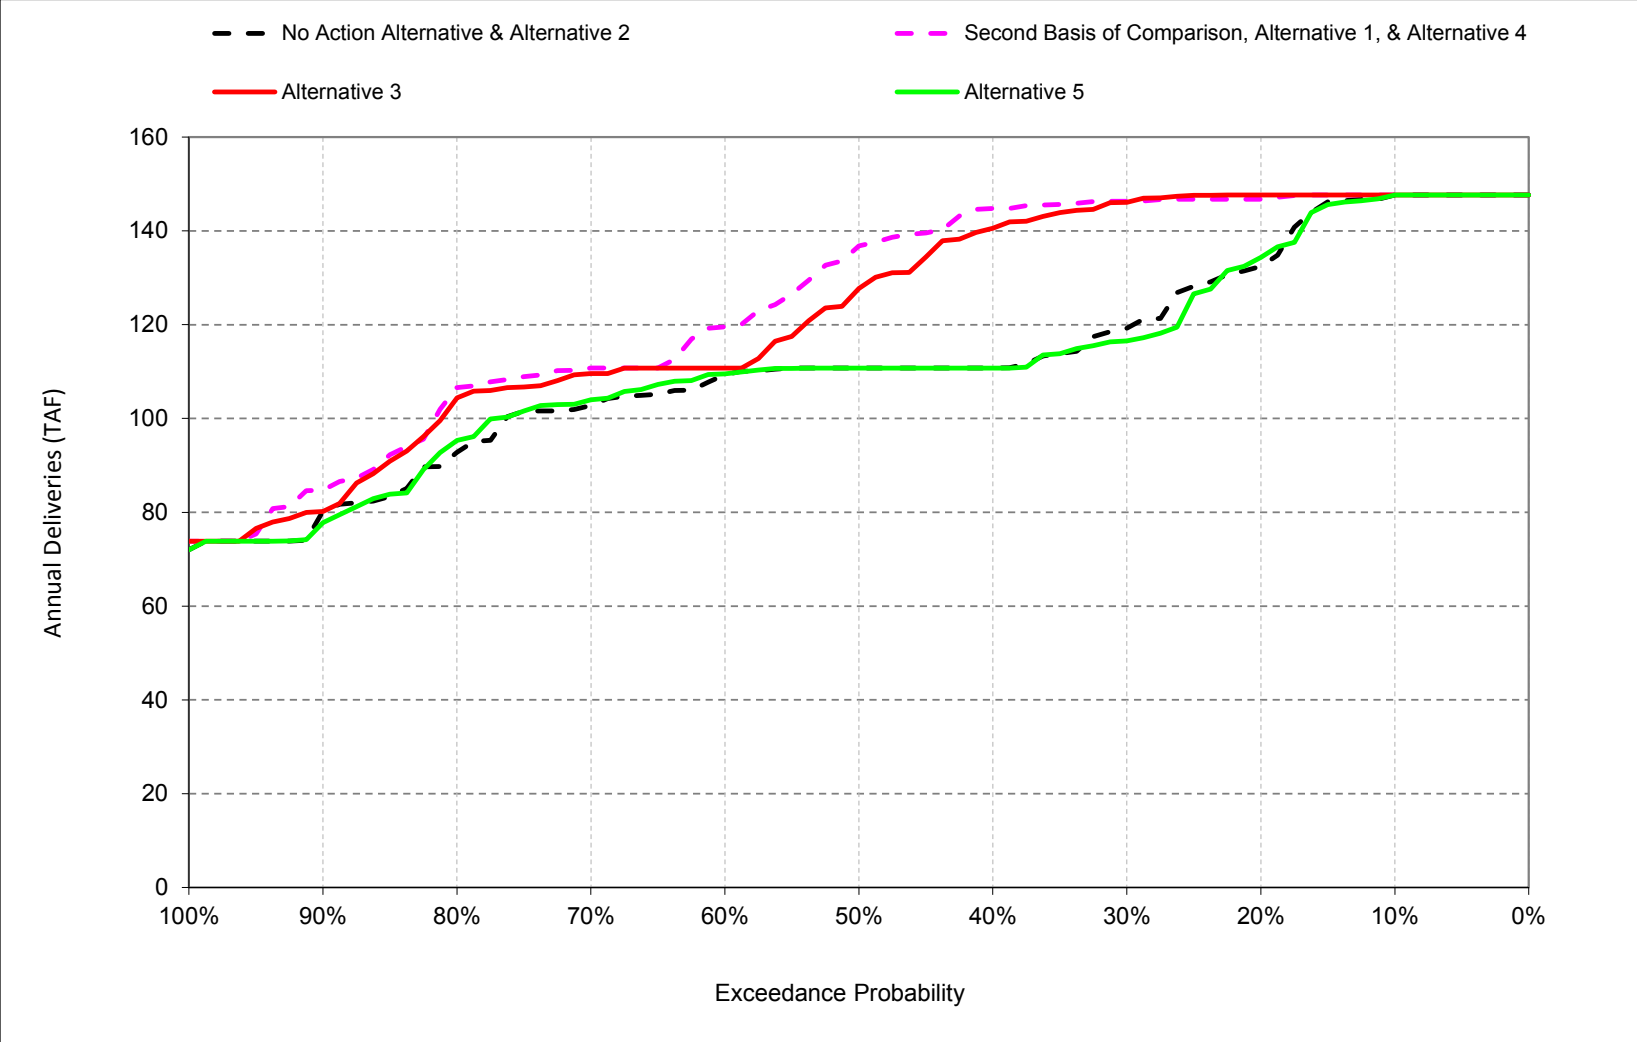


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 5) Does not include Eastside Contractors deliveries. 6) Annual deliveries are based on March to February Average.

Figure C-19-1-6. Annual CVP Settlement Contractors Deliveries

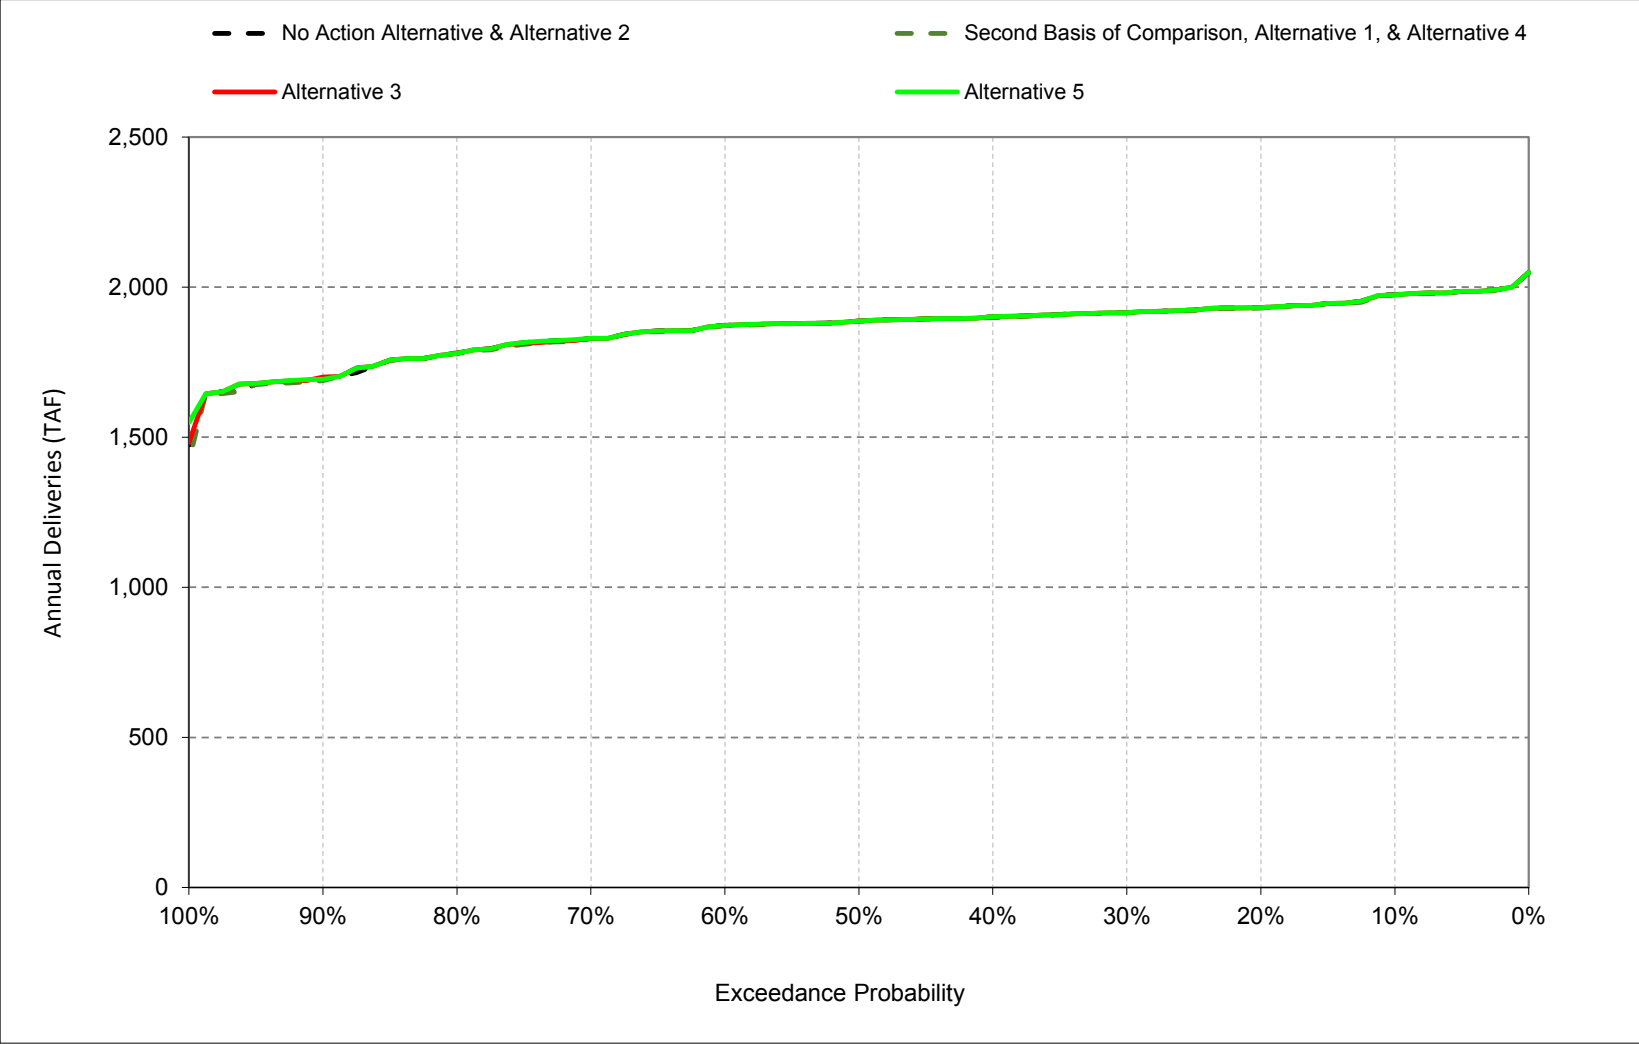


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 5) Annual deliveries are based on March to February Average.

Figure C-19-1-7. Annual CVP Exchange Contractors Deliveries

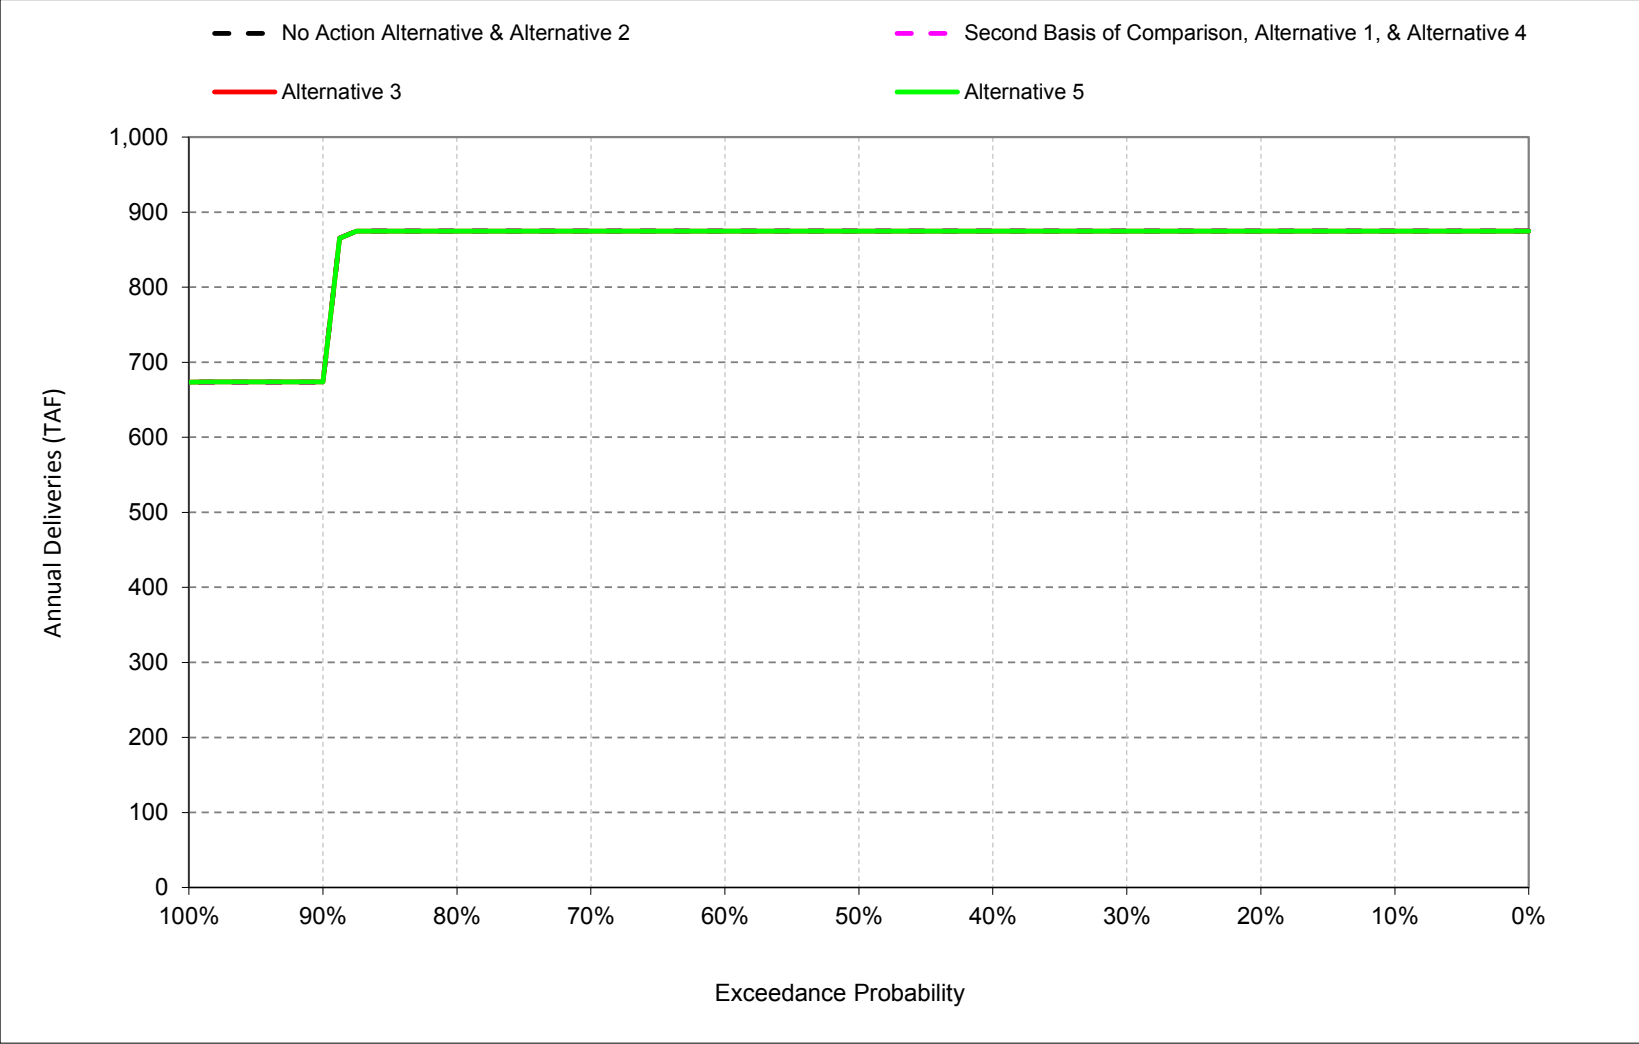


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 5) Annual deliveries are based on March to February Average.

Figure C-19-1-8. Annual CVP Total Deliveries

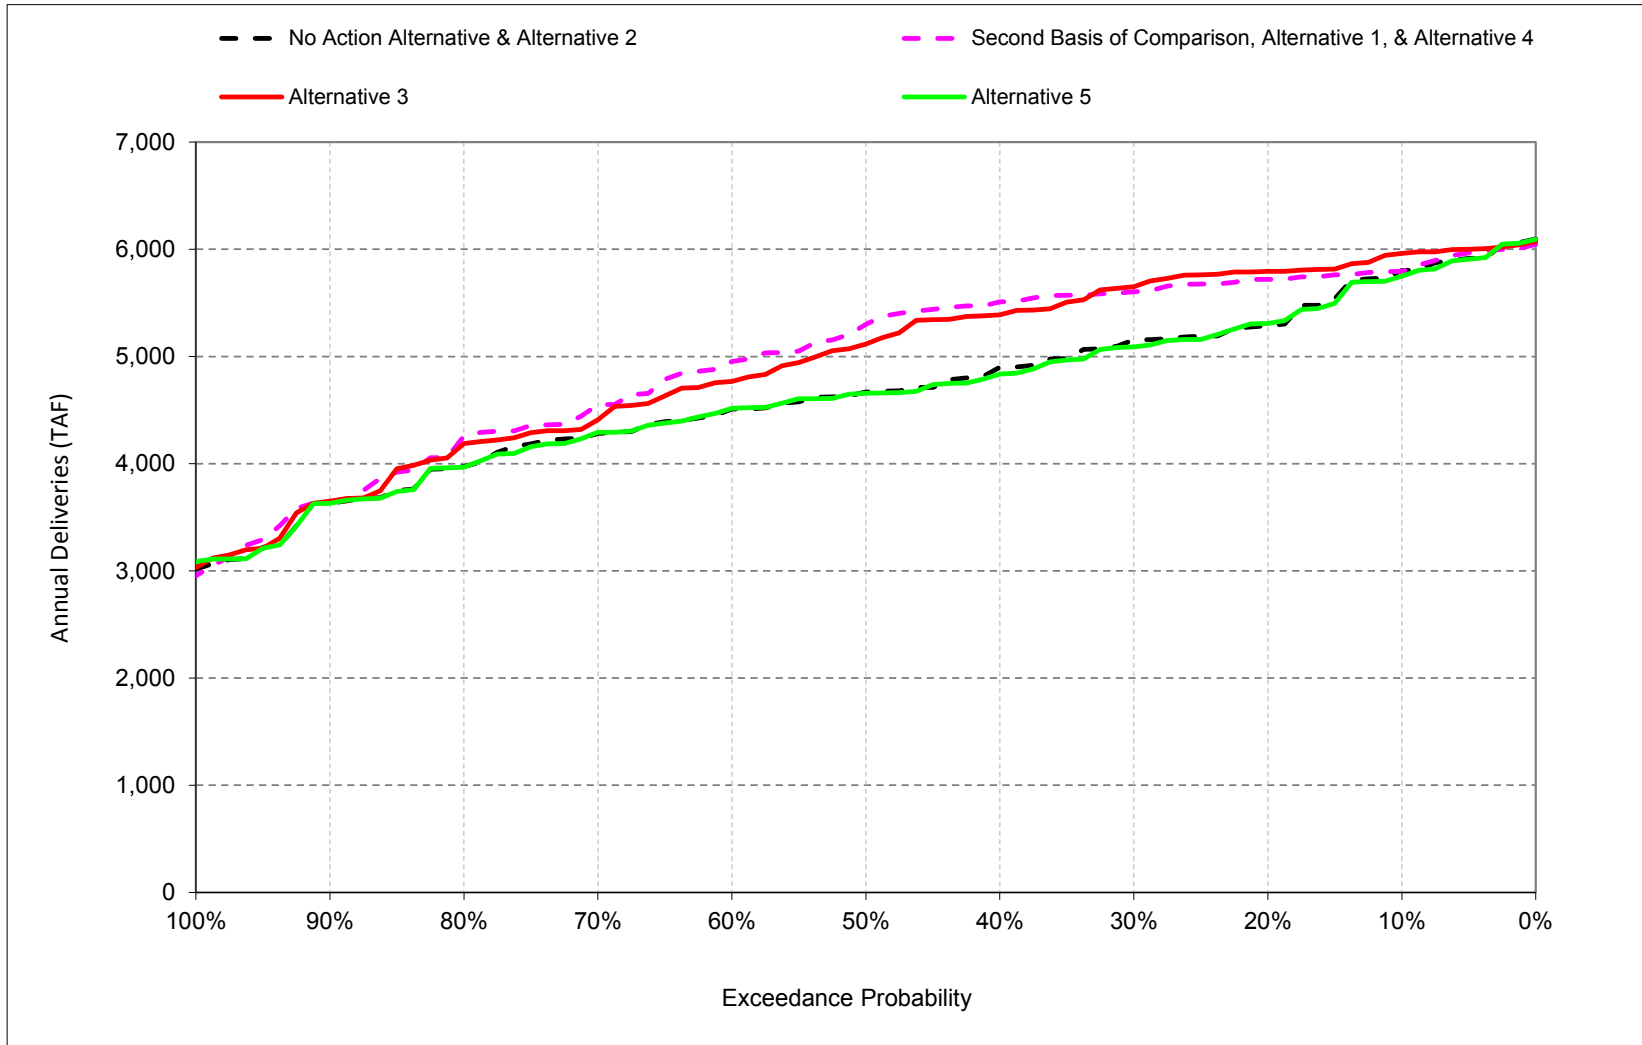

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 5) Does not include Eastside Contractors deliveries. 6) Annual deliveries are based on March to February Average.

Figure C-19-1-9. Annual CVP Eastside Contractors Deliveries

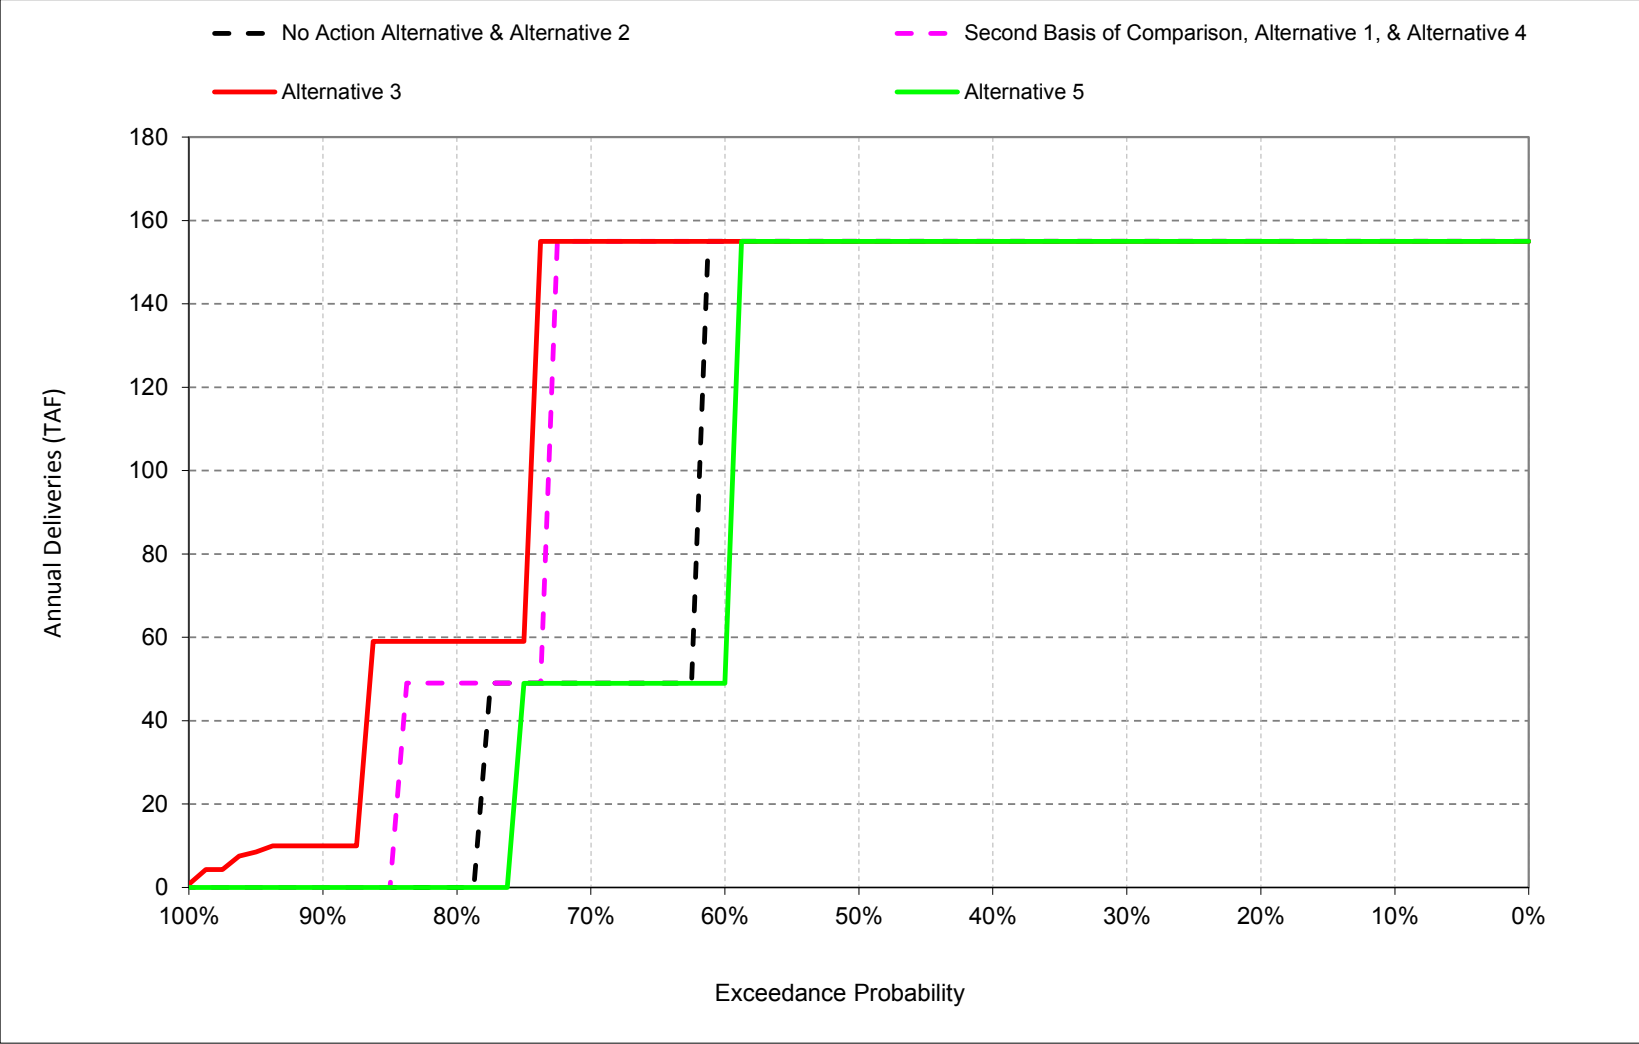

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 5) Annual deliveries are based on March to February Average.

Appendix 5A: CalSim II and DSM2 Modeling Results

Table C-19-1-1. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP Deliveries

				Alternative 1	No Action Alternative	Alternative 1 minus No Action Alternative
Water Supply Reliability						
Sacramento River Hydrologic Region						
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term	1,858	1,859	-1
			Dry	1,905	1,906	-1
			Critical	1,732	1,737	-5
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	155	146	8
			Dry	151	146	5
			Critical	105	102	3
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	214	207	7
			Dry	192	186	5
			Critical	151	152	-1
CVP Ag	Contract Delivery (annual average - does not include Settlement contractors)	(TAF/year)	Long Term	219	185	34
			Dry	122	86	37
			Critical	35	24	12
San Joaquin River Hydrologic Region (not including Friant-Kern and Madera Canal water users and Eastside Contractors deliveries)						
CVP Exchange	Contract Delivery (annual average)	(TAF/year)	Long Term	852	852	0
			Dry	875	875	0
			Critical	741	741	0
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	260	261	0
			Dry	268	269	-1
			Critical	221	224	-3
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	17	15	2
			Dry	15	14	1
			Critical	12	11	1
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	348	269	79
			Dry	203	140	63
			Critical	61	41	20
San Francisco Bay Hydrologic Region						
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	286	275	11
			Dry	292	284	9
			Critical	305	301	4
CVP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	43	33	11
			Dry	25	17	8
			Critical	7	5	2
Central Coast Hydrologic Region						
Tulare Lake Hydrologic Region (not including Friant-Kern Canal water users)						
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	12	12	0
			Dry	12	12	0
			Critical	10	10	0
CVP Ag	Contract Delivery (annual average - includes Cross Valley Canal)	(TAF/year)	Long Term	709	545	164
			Dry	422	288	134
			Critical	127	85	41
Total For All Regions						
Total Supplies	Contract Delivery (annual average)	(TAF/year)	Long Term	4,973	4,660	313
			Dry	4,483	4,221	261
			Critical	3,508	3,433	75

Notes:

- 1) Long-term Average is the average quantity for the 82-year simulation period.
- 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
- 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.
- 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences are discussed in the text.
- 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text.
- 6) Annual deliveries are based on March to February Average.
- 7) In the table on the following page, San Francisco Bay Hydrologic Region M&I deliveries are divided between North of Delta M&I deliveries (Contra Costa Water District) and South of Delta M&I deliveries (San Felipe Division); and San Francisco Bay Hydrologic Region Ag deliveries are only included in South of Delta Ag deliveries.

Appendix 5A: CalSim II and DSM2 Modeling Results

Table C-19-1-2. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP

				Alternative 1	No Action Alternative	Alternative 1 minus No Action Alternative
Water Supply Reliability						
North of Delta						
CVP Ag	Contract Delivery (annual average; does not include Settlement contractors)	(TAF/year)	Long Term	219	185	34
			Dry	122	86	37
			Critical	35	24	12
CVP M&I (Including American River)	Contract Delivery (annual average)	(TAF/year)	Long Term	392	386	7
			Dry	390	385	5
			Critical	383	383	-1
CVP M&I American River	Contract Delivery (annual average)	(TAF/year)	Long Term	120	113	7
			Dry	105	97	8
			Critical	79	75	5
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term	1,858	1,859	-1
			Dry	1,905	1,906	-1
			Critical	1,732	1,737	-5
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	155	146	8
			Dry	151	146	5
			Critical	105	102	3
Total CVP North of Delta Ag and M&I Deliveries						
Total CVP Ag and M&I Deliveries	Contract Delivery (CVP) (annual average)	(TAF/year)	Long Term	612	571	41
			Dry	512	470	42
			Critical	418	407	11
South of Delta (Not including Eastside Contractors deliveries, or Friant-Kern Canal or Madera Canal water users)						
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	1,100	847	253
			Dry	650	445	206
			Critical	195	131	64
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	125	112	13
			Dry	109	99	10
			Critical	85	80	4
CVP Exchange	Contract Delivery (annual average)	(TAF/year)	Long Term	852	852	0
			Dry	875	875	0
			Critical	741	741	0
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	272	273	-1
			Dry	280	281	-1
			Critical	232	234	-3
Total CVP South of Delta Ag and M&I Deliveries						
Total CVP Ag and M&I Deliveries	Contract Delivery (annual average)	(TAF/year)	Long Term	1,225	958	266
			Dry	759	544	216
			Critical	280	212	68
Eastside Contractors deliveries						
Water Rights	Delivery (annual average)	(TAF/year)	Long Term	514	508	6
			Dry	524	524	0
			Critical	486	445	42
CVP Service Contracts	Contract Delivery (annual average)	(TAF/year)	Long Term	118	104	15
			Dry	98	84	13
			Critical	25	4	21
Total Eastside Contractors Deliveries						
Total Water Rights and CVP Service Contracts Deliveries	Delivery (annual average)	(TAF/year)	Long Term	632	611	21
			Dry	621	608	13
			Critical	511	449	63

Notes:

- 1) Long-term Average is the average quantity for the 82-year simulation period.
- 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
- 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.
- 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences are discussed in the text.
- 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text.
- 6) Annual deliveries are based on March to February Average.

Table C-19-2-1. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP Deliveries

				Alternative 3	No Action Alternative	Alternative 3 minus No Action Alternative
Water Supply Reliability						
Sacramento River Hydrologic Region						
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term	1,860	1,859	1
			Dry	1,906	1,906	0
			Critical	1,742	1,737	5
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	153	146	7
			Dry	149	146	4
			Critical	103	102	1
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	214	207	6
			Dry	192	186	6
			Critical	152	152	1
CVP Ag	Contract Delivery (annual average - does not include Settlement contractors)	(TAF/year)	Long Term	209	185	24
			Dry	111	86	25
			Critical	31	24	7
San Joaquin River Hydrologic Region (not including Friant-Kern and Madera Canal water users and Eastside Contractors deliveries)						
CVP Exchange	Contract Delivery (annual average)	(TAF/year)	Long Term	852	852	0
			Dry	875	875	0
			Critical	741	741	0
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	261	261	0
			Dry	269	269	0
			Critical	224	224	0
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	17	15	1
			Dry	15	14	1
			Critical	11	11	0
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	342	269	73
			Dry	185	140	45
			Critical	53	41	12
San Francisco Bay Hydrologic Region						
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	284	275	9
			Dry	291	284	7
			Critical	304	301	2
CVP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	42	33	9
			Dry	23	17	6
			Critical	6	5	1
Central Coast Hydrologic Region						
Tulare Lake Hydrologic Region (not including Friant-Kern Canal water users)						
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	12	12	0
			Dry	12	12	0
			Critical	10	10	0
CVP Ag	Contract Delivery (annual average - includes Cross Valley Canal)	(TAF/year)	Long Term	696	545	150
			Dry	387	288	99
			Critical	108	85	23
Total For All Regions						
Total Supplies	Contract Delivery (annual average)	(TAF/year)	Long Term	4,942	4,660	282
			Dry	4,415	4,221	194
			Critical	3,486	3,433	53

Notes:

- 1) Long-term Average is the average quantity for the 82-year simulation period.
- 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
- 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.
- 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text.
- 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text.
- 6) Annual deliveries are based on March to February Average.
- 7) In the table on the following page, San Francisco Bay Hydrologic Region M&I deliveries are divided between North of Delta M&I deliveries (Contra Costa Water District) and South of Delta M&I deliveries (San Felipe Division); and San Francisco Bay Hydrologic Region Ag deliveries are only included in South of Delta Ag deliveries.

Table C-19-2-2. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP

				Alternative 3	No Action Alternative	Alternative 3 minus No Action Alternative
Water Supply Reliability						
North of Delta						
CVP Ag	Contract Delivery (annual average; does not include Settlement contractors)	(TAF/year)	Long Term	209	185	24
			Dry	111	86	25
			Critical	31	24	7
CVP M&I (Including American River)	Contract Delivery (annual average)	(TAF/year)	Long Term	392	386	6
			Dry	390	385	6
			Critical	384	383	1
CVP M&I American River	Contract Delivery (annual average)	(TAF/year)	Long Term	118	113	6
			Dry	104	97	7
			Critical	78	75	3
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term	1,860	1,859	1
			Dry	1,906	1,906	0
			Critical	1,742	1,737	5
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	153	146	7
			Dry	149	146	4
			Critical	103	102	1
Total CVP North of Delta Ag and M&I Deliveries						
Total CVP Ag and M&I Deliveries	Contract Delivery (CVP) (annual average)	(TAF/year)	Long Term	602	571	30
			Dry	501	470	31
			Critical	415	407	8
South of Delta (Not including Eastside Contractors deliveries, or Friant-Kern Canal or Madera Canal water users)						
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	1,079	847	233
			Dry	596	445	151
			Critical	168	131	36
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	122	112	11
			Dry	108	99	8
			Critical	83	80	2
CVP Exchange	Contract Delivery (annual average)	(TAF/year)	Long Term	852	852	0
			Dry	875	875	0
			Critical	741	741	0
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	273	273	0
			Dry	281	281	0
			Critical	234	234	0
Total CVP South of Delta Ag and M&I Deliveries						
Total CVP Ag and M&I Deliveries	Contract Delivery (annual average)	(TAF/year)	Long Term	1,202	958	243
			Dry	703	544	159
			Critical	250	212	38
Eastside Contractors deliveries						
Water Rights	Delivery (annual average)	(TAF/year)	Long Term	513	508	5
			Dry	524	524	0
			Critical	478	445	33
CVP Service Contracts	Contract Delivery (annual average)	(TAF/year)	Long Term	123	104	20
			Dry	109	84	25
			Critical	36	4	32
Total Eastside Contractors Deliveries						
Total Water Rights and CVP Service Contracts Deliveries	Delivery (annual average)	(TAF/year)	Long Term	636	611	25
			Dry	633	608	25
			Critical	514	449	66

Notes:

- 1) Long-term Average is the average quantity for the 82-year simulation period.
- 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
- 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.
- 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text.
- 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text.
- 6) Annual deliveries are based on March to February Average.

Table C-19-3-1. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP Deliveries

				Alternative 5	No Action Alternative	Alternative 5 minus No Action Alternative
Water Supply Reliability						
Sacramento River Hydrologic Region						
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term	1,861	1,859	2
			Dry	1,906	1,906	0
			Critical	1,747	1,737	10
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	146	146	0
			Dry	145	146	0
			Critical	103	102	1
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	207	207	0
			Dry	186	186	0
			Critical	152	152	0
CVP Ag	Contract Delivery (annual average - does not include Settlement contractors)	(TAF/year)	Long Term	185	185	0
			Dry	85	86	0
			Critical	24	24	0
San Joaquin River Hydrologic Region (not including Friant-Kern and Madera Canal water users and Eastside Contractors deliveries)						
CVP Exchange	Contract Delivery (annual average)	(TAF/year)	Long Term	852	852	0
			Dry	875	875	0
			Critical	741	741	0
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	261	261	0
			Dry	269	269	0
			Critical	222	224	-2
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	15	15	0
			Dry	14	14	0
			Critical	11	11	0
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	264	269	-5
			Dry	135	140	-5
			Critical	40	41	-1
San Francisco Bay Hydrologic Region						
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	275	275	0
			Dry	284	284	1
			Critical	301	301	0
CVP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	32	33	0
			Dry	17	17	0
			Critical	5	5	0
Central Coast Hydrologic Region						
Tulare Lake Hydrologic Region (not including Friant-Kern Canal water users)						
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	12	12	0
			Dry	12	12	0
			Critical	10	10	0
CVP Ag	Contract Delivery (annual average - includes Cross Valley Canal)	(TAF/year)	Long Term	538	545	-7
			Dry	281	288	-7
			Critical	85	85	0
Total For All Regions						
Total Supplies	Contract Delivery (annual average)	(TAF/year)	Long Term	4,649	4,660	-11
			Dry	4,210	4,221	-12
			Critical	3,441	3,433	8

Notes:

- 1) Long-term Average is the average quantity for the 82-year simulation period.
- 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
- 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.
- 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text.
- 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text.
- 6) Annual deliveries are based on March to February Average.
- 7) In the table on the following page, San Francisco Bay Hydrologic Region M&I deliveries are divided between North of Delta M&I deliveries (Contra Costa Water District) and South of Delta M&I deliveries (San Felipe Division); and San Francisco Bay Hydrologic Region Ag deliveries are only included in South of Delta Ag deliveries.

Table C-19-3-2. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP

				Alternative 5	No Action Alternative	Alternative 5 minus No Action Alternative
Water Supply Reliability						
North of Delta						
CVP Ag	Contract Delivery (annual average; does not include Settlement contractors)	(TAF/year)	Long Term	185	185	0
			Dry	85	86	0
			Critical	24	24	0
CVP M&I (Including American River)	Contract Delivery (annual average)	(TAF/year)	Long Term	386	386	0
			Dry	384	385	0
			Critical	384	383	1
CVP M&I American River	Contract Delivery (annual average)	(TAF/year)	Long Term	112	113	0
			Dry	96	97	0
			Critical	74	75	-1
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term	1,861	1,859	2
			Dry	1,906	1,906	0
			Critical	1,747	1,737	10
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	146	146	0
			Dry	145	146	0
			Critical	103	102	1
Total CVP North of Delta Ag and M&I Deliveries						
Total CVP Ag and M&I Deliveries	Contract Delivery (CVP) (annual average)	(TAF/year)	Long Term	571	571	0
			Dry	470	470	0
			Critical	408	407	1
South of Delta (Not including Eastside Contractors deliveries, or Friant-Kern Canal or Madera Canal water users)						
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	834	847	-13
			Dry	433	445	-12
			Critical	130	131	-1
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	112	112	0
			Dry	100	99	1
			Critical	80	80	0
CVP Exchange	Contract Delivery (annual average)	(TAF/year)	Long Term	852	852	0
			Dry	875	875	0
			Critical	741	741	0
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	273	273	0
			Dry	281	281	0
			Critical	232	234	-2
Total CVP South of Delta Ag and M&I Deliveries						
Total CVP Ag and M&I Deliveries	Contract Delivery (annual average)	(TAF/year)	Long Term	946	958	-13
			Dry	533	544	-11
			Critical	210	212	-2
Eastside Contractors deliveries						
Water Rights	Delivery (annual average)	(TAF/year)	Long Term	502	508	-6
			Dry	524	524	0
			Critical	406	445	-39
CVP Service Contracts	Contract Delivery (annual average)	(TAF/year)	Long Term	100	104	-4
			Dry	69	84	-16
			Critical	8	4	4
Total Eastside Contractors Deliveries						
Total Water Rights and CVP Service Contracts Deliveries	Delivery (annual average)	(TAF/year)	Long Term	602	611	-10
			Dry	593	608	-16
			Critical	414	449	-35

Notes:

- 1) Long-term Average is the average quantity for the 82-year simulation period.
- 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
- 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.
- 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text.
- 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text.
- 6) Annual deliveries are based on March to February Average.

Table C-19-4-1. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP Deliveries

				No Action Alternative	Second Basis of Comparison	No Action Alternative minus Second Basis of Comparison
Water Supply Reliability						
Sacramento River Hydrologic Region						
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term	1,859	1,858	1
			Dry	1,906	1,905	1
			Critical	1,737	1,732	5
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	146	155	-8
			Dry	146	151	-5
			Critical	102	105	-3
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	207	214	-7
			Dry	186	192	-5
			Critical	152	151	1
CVP Ag	Contract Delivery (annual average - does not include Settlement contractors)	(TAF/year)	Long Term	185	219	-34
			Dry	86	122	-37
			Critical	24	35	-12
San Joaquin River Hydrologic Region (not including Friant-Kern and Madera Canal water users and Eastside Contractors deliveries)						
CVP Exchange	Contract Delivery (annual average)	(TAF/year)	Long Term	852	852	0
			Dry	875	875	0
			Critical	741	741	0
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	261	260	0
			Dry	269	268	1
			Critical	224	221	3
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	15	17	-2
			Dry	14	15	-1
			Critical	11	12	-1
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	269	348	-79
			Dry	140	203	-63
			Critical	41	61	-20
San Francisco Bay Hydrologic Region						
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	275	286	-11
			Dry	284	292	-9
			Critical	301	305	-4
CVP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	33	43	-11
			Dry	17	25	-8
			Critical	5	7	-2
Central Coast Hydrologic Region						
Tulare Lake Hydrologic Region (not including Friant-Kern Canal water users)						
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	12	12	0
			Dry	12	12	0
			Critical	10	10	0
CVP Ag	Contract Delivery (annual average - includes Cross Valley Canal)	(TAF/year)	Long Term	545	709	-164
			Dry	288	422	-134
			Critical	85	127	-41
Total For All Regions						
Total Supplies	Contract Delivery (annual average)	(TAF/year)	Long Term	4,660	4,973	-313
			Dry	4,221	4,483	-261
			Critical	3,433	3,508	-75

Notes:

- 1) Long-term Average is the average quantity for the 82-year simulation period.
- 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
- 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.
- 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text.
- 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text.
- 6) Annual deliveries are based on March to February Average.
- 7) In the table on the following page, San Francisco Bay Hydrologic Region M&I deliveries are divided between North of Delta M&I deliveries (Contra Costa Water District) and South of Delta M&I deliveries (San Felipe Division); and San Francisco Bay Hydrologic Region Ag deliveries are only included in South of Delta Ag deliveries.

Table C-19-4-2. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP

				No Action Alternative	Second Basis of Comparison	No Action Alternative minus Second Basis of Comparison
Water Supply Reliability						
North of Delta						
CVP Ag	Contract Delivery (annual average; does not include Settlement contractors)	(TAF/year)	Long Term	185	219	-34
			Dry	86	122	-37
			Critical	24	35	-12
CVP M&I (Including American River)	Contract Delivery (annual average)	(TAF/year)	Long Term	386	392	-7
			Dry	385	390	-5
			Critical	383	383	1
CVP M&I American River	Contract Delivery (annual average)	(TAF/year)	Long Term	113	120	-7
			Dry	97	105	-8
			Critical	75	79	-5
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term	1,859	1,858	1
			Dry	1,906	1,905	1
			Critical	1,737	1,732	5
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	146	155	-8
			Dry	146	151	-5
			Critical	102	105	-3
Total CVP North of Delta Ag and M&I Deliveries						
Total CVP Ag and M&I Deliveries	Contract Delivery (CVP) (annual average)	(TAF/year)	Long Term	571	612	-41
			Dry	470	512	-42
			Critical	407	418	-11
South of Delta (Not including Eastside Contractors deliveries, or Friant-Kern Canal or Madera Canal water users)						
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	847	1,100	-253
			Dry	445	650	-206
			Critical	131	195	-64
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	112	125	-13
			Dry	99	109	-10
			Critical	80	85	-4
CVP Exchange	Contract Delivery (annual average)	(TAF/year)	Long Term	852	852	0
			Dry	875	875	0
			Critical	741	741	0
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	273	272	1
			Dry	281	280	1
			Critical	234	232	3
Total CVP South of Delta Ag and M&I Deliveries						
Total CVP Ag and M&I Deliveries	Contract Delivery (annual average)	(TAF/year)	Long Term	958	1,225	-266
			Dry	544	759	-216
			Critical	212	280	-68
Eastside Contractors deliveries						
Water Rights	Delivery (annual average)	(TAF/year)	Long Term	508	514	-6
			Dry	524	524	0
			Critical	445	486	-42
CVP Service Contracts	Contract Delivery (annual average)	(TAF/year)	Long Term	104	118	-15
			Dry	84	98	-13
			Critical	4	25	-21
Total Eastside Contractors Deliveries						
Total Water Rights and CVP Service Contracts Deliveries	Delivery (annual average)	(TAF/year)	Long Term	611	632	-21
			Dry	608	621	-13
			Critical	449	511	-63

Notes:

- 1) Long-term Average is the average quantity for the 82-year simulation period.
- 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
- 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.
- 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text.
- 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text.
- 6) Annual deliveries are based on March to February Average.

Appendix 5A: CalSim II and DSM2 Modeling Results

Table C-19-5-1. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP Deliveries

				Alternative 3	Second Basis of Comparison	Alternative 3 minus Second Basis of Comparison
Water Supply Reliability						
Sacramento River Hydrologic Region						
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term	1,860	1,858	2
			Dry	1,906	1,905	1
			Critical	1,742	1,732	10
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	153	155	-1
			Dry	149	151	-2
			Critical	103	105	-2
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	214	214	0
			Dry	192	192	0
			Critical	152	151	2
CVP Ag	Contract Delivery (annual average - does not include Settlement contractors)	(TAF/year)	Long Term	209	219	-10
			Dry	111	122	-11
			Critical	31	35	-4
San Joaquin River Hydrologic Region (not including Friant-Kern and Madera Canal water users and Eastside Contractors deliveries)						
CVP Exchange	Contract Delivery (annual average)	(TAF/year)	Long Term	852	852	0
			Dry	875	875	0
			Critical	741	741	0
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	261	260	1
			Dry	269	268	1
			Critical	224	221	3
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	17	17	0
			Dry	15	15	0
			Critical	11	12	0
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	342	348	-6
			Dry	185	203	-17
			Critical	53	61	-8
San Francisco Bay Hydrologic Region						
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	284	286	-2
			Dry	291	292	-1
			Critical	304	305	-2
CVP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	42	43	-1
			Dry	23	25	-2
			Critical	6	7	-1
Central Coast Hydrologic Region						
Tulare Lake Hydrologic Region (not including Friant-Kern Canal water users)						
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	12	12	0
			Dry	12	12	0
			Critical	10	10	0
CVP Ag	Contract Delivery (annual average - includes Cross Valley Canal)	(TAF/year)	Long Term	696	709	-13
			Dry	387	422	-35
			Critical	108	127	-18
Total For All Regions						
Total Supplies	Contract Delivery (annual average)	(TAF/year)	Long Term	4,942	4,973	-32
			Dry	4,415	4,483	-67
			Critical	3,486	3,508	-22

Notes:

- 1) Long-term Average is the average quantity for the 82-year simulation period.
- 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
- 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.
- 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text.
- 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text.
- 6) Annual deliveries are based on March to February Average.
- 7) In the table on the following page, San Francisco Bay Hydrologic Region M&I deliveries are divided between North of Delta M&I deliveries (Contra Costa Water District) and South of Delta M&I deliveries (San Felipe Division); and San Francisco Bay Hydrologic Region Ag deliveries are only included in South of Delta Ag deliveries.

Appendix 5A: CalSim II and DSM2 Modeling Results

Table C-19-5-2. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP

				Alternative 3	Second Basis of Comparison	Alternative 3 minus Second Basis of Comparison
Water Supply Reliability						
North of Delta						
CVP Ag	Contract Delivery (annual average; does not include Settlement contractors)	(TAF/year)	Long Term	209	219	-10
			Dry	111	122	-11
			Critical	31	35	-4
CVP M&I (Including American River)	Contract Delivery (annual average)	(TAF/year)	Long Term	392	392	0
			Dry	390	390	0
			Critical	384	383	2
CVP M&I American River	Contract Delivery (annual average)	(TAF/year)	Long Term	118	120	-2
			Dry	104	105	-1
			Critical	78	79	-2
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term	1,860	1,858	2
			Dry	1,906	1,905	1
			Critical	1,742	1,732	10
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	153	155	-1
			Dry	149	151	-2
			Critical	103	105	-2
Total CVP North of Delta Ag and M&I Deliveries						
Total CVP Ag and M&I Deliveries	Contract Delivery (CVP) (annual average)	(TAF/year)	Long Term	602	612	-10
			Dry	501	512	-11
			Critical	415	418	-3
South of Delta (Not including Eastside Contractors deliveries, or Friant-Kern Canal or Madera Canal water users)						
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	1,079	1,100	-20
			Dry	596	650	-55
			Critical	168	195	-28
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	122	125	-2
			Dry	108	109	-1
			Critical	83	85	-2
CVP Exchange	Contract Delivery (annual average)	(TAF/year)	Long Term	852	852	0
			Dry	875	875	0
			Critical	741	741	0
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	273	272	1
			Dry	281	280	1
			Critical	234	232	3
Total CVP South of Delta Ag and M&I Deliveries						
Total CVP Ag and M&I Deliveries	Contract Delivery (annual average)	(TAF/year)	Long Term	1,202	1,225	-23
			Dry	703	759	-56
			Critical	250	280	-30
Eastside Contractors deliveries						
Water Rights	Delivery (annual average)	(TAF/year)	Long Term	513	514	-1
			Dry	524	524	0
			Critical	478	486	-8
CVP Service Contracts	Contract Delivery (annual average)	(TAF/year)	Long Term	123	118	5
			Dry	109	98	12
			Critical	36	25	11
Total Eastside Contractors Deliveries						
Total Water Rights and CVP Service Contracts Deliveries	Delivery (annual average)	(TAF/year)	Long Term	636	632	4
			Dry	633	621	12
			Critical	514	511	3

Notes:

- 1) Long-term Average is the average quantity for the 82-year simulation period.
- 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
- 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.
- 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text.
- 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text.
- 6) Annual deliveries are based on March to February Average.

Table C-19-6-1. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP Deliveries

				Alternative 5	Second Basis of Comparison	Alternative 5 minus Second Basis of Comparison
Water Supply Reliability						
Sacramento River Hydrologic Region						
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term	1,861	1,858	3
			Dry	1,906	1,905	1
			Critical	1,747	1,732	15
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	146	155	-8
			Dry	145	151	-6
			Critical	103	105	-2
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	207	214	-6
			Dry	186	192	-6
			Critical	152	151	1
CVP Ag	Contract Delivery (annual average - does not include Settlement contractors)	(TAF/year)	Long Term	185	219	-34
			Dry	85	122	-37
			Critical	24	35	-11
San Joaquin River Hydrologic Region (not including Friant-Kern and Madera Canal water users and Eastside Contractors deliveries)						
CVP Exchange	Contract Delivery (annual average)	(TAF/year)	Long Term	852	852	0
			Dry	875	875	0
			Critical	741	741	0
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	261	260	0
			Dry	269	268	1
			Critical	222	221	0
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	15	17	-2
			Dry	14	15	-1
			Critical	11	12	-1
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	264	348	-84
			Dry	135	203	-68
			Critical	40	61	-21
San Francisco Bay Hydrologic Region						
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	275	286	-11
			Dry	284	292	-8
			Critical	301	305	-4
CVP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	32	43	-11
			Dry	17	25	-8
			Critical	5	7	-2
Central Coast Hydrologic Region						
Tulare Lake Hydrologic Region (not including Friant-Kern Canal water users)						
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	12	12	0
			Dry	12	12	0
			Critical	10	10	0
CVP Ag	Contract Delivery (annual average - includes Cross Valley Canal)	(TAF/year)	Long Term	538	709	-171
			Dry	281	422	-141
			Critical	85	127	-42
Total For All Regions						
Total Supplies	Contract Delivery (annual average)	(TAF/year)	Long Term	4,649	4,973	-324
			Dry	4,210	4,483	-273
			Critical	3,441	3,508	-67

Notes:

- 1) Long-term Average is the average quantity for the 82-year simulation period.
- 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
- 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.
- 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text.
- 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text.
- 6) Annual deliveries are based on March to February Average.
- 7) In the table on the following page, San Francisco Bay Hydrologic Region M&I deliveries are divided between North of Delta M&I deliveries (Contra Costa Water District) and South of Delta M&I deliveries (San Felipe Division); and San Francisco Bay Hydrologic Region Ag deliveries are only included in South of Delta Ag deliveries.

Appendix 5A: CalSim II and DSM2 Modeling Results

Table C-19-6-2. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP

				Alternative 5	Second Basis of Comparison	Alternative 5 minus Second Basis of Comparison
Water Supply Reliability						
North of Delta						
CVP Ag	Contract Delivery (annual average; does not include Settlement contractors)	(TAF/year)	Long Term	185	219	-34
			Dry	85	122	-37
			Critical	24	35	-11
CVP M&I (Including American River)	Contract Delivery (annual average)	(TAF/year)	Long Term	386	392	-6
			Dry	384	390	-6
			Critical	384	383	1
CVP M&I American River	Contract Delivery (annual average)	(TAF/year)	Long Term	112	120	-7
			Dry	96	105	-9
			Critical	74	79	-6
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term	1,861	1,858	3
			Dry	1,906	1,905	1
			Critical	1,747	1,732	15
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	146	155	-8
			Dry	145	151	-6
			Critical	103	105	-2
Total CVP North of Delta Ag and M&I Deliveries						
Total CVP Ag and M&I Deliveries	Contract Delivery (CVP) (annual average)	(TAF/year)	Long Term	571	612	-41
			Dry	470	512	-42
			Critical	408	418	-10
South of Delta (Not including Eastside Contractors deliveries, or Friant-Kern Canal or Madera Canal water users)						
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	834	1,100	-266
			Dry	433	650	-217
			Critical	130	195	-65
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	112	125	-13
			Dry	100	109	-9
			Critical	80	85	-5
CVP Exchange	Contract Delivery (annual average)	(TAF/year)	Long Term	852	852	0
			Dry	875	875	0
			Critical	741	741	0
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	273	272	0
			Dry	281	280	1
			Critical	232	232	0
Total CVP South of Delta Ag and M&I Deliveries						
Total CVP Ag and M&I Deliveries	Contract Delivery (annual average)	(TAF/year)	Long Term	946	1,225	-279
			Dry	533	759	-226
			Critical	210	280	-70
Eastside Contractors deliveries						
Water Rights	Delivery (annual average)	(TAF/year)	Long Term	502	514	-12
			Dry	524	524	0
			Critical	406	486	-80
CVP Service Contracts	Contract Delivery (annual average)	(TAF/year)	Long Term	100	118	-19
			Dry	69	98	-29
			Critical	8	25	-17
Total Eastside Contractors Deliveries						
Total Water Rights and CVP Service Contracts Deliveries	Delivery (annual average)	(TAF/year)	Long Term	602	632	-31
			Dry	593	621	-29
			Critical	414	511	-97

Notes:

- 1) Long-term Average is the average quantity for the 82-year simulation period.
- 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
- 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.
- 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text.
- 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text.
- 6) Annual deliveries are based on March to February Average.

Table C-19-7. Stanislaus CVP and Water Rights Deliveries, Long-Term Averages


	Stanislaus Deliveries		Difference from No Action Alternative		Difference from Second Basis of Comparison	
	CVP	Water Rights	CVP	Water Rights	CVP	Water Rights
	(TAF)	(TAF)	(TAF)	(TAF)	(TAF)	(TAF)
No Action Alternative	103.5	507.8				
Second Basis of Comparison	118.3	514.0	14.8	6.2		
Alternative 2	103.5	507.8			-14.8	-6.2
Alternative 3	123.2	512.7	19.6	4.9	4.8	-1.2
Alternative 5	99.7	502.1	-3.8	-5.7	-18.6	-11.9

Notes:

- 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.
- 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text.
- 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.


1 **C.20. SWP Deliveries**

Figure C-20-1-1. Total Annual SWP Deliveries

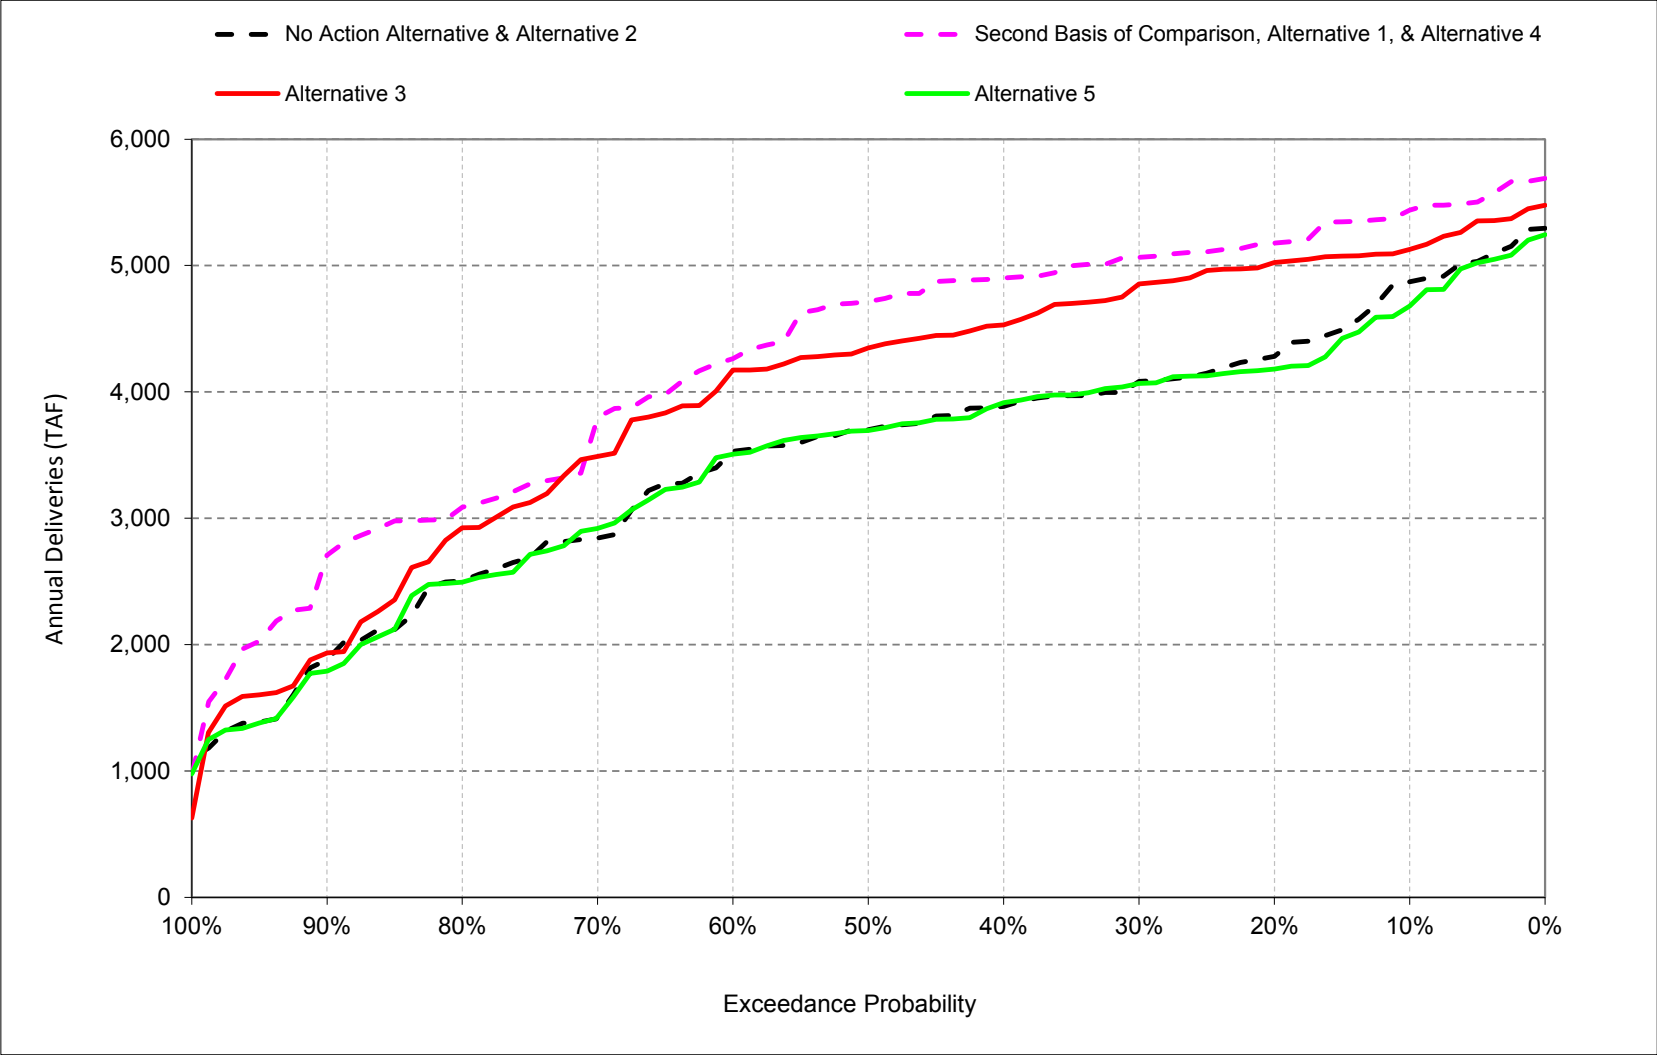


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 6) Annual deliveries are based on January to December average.

Figure C-20-1-2. Total Annual SWP South of Delta Deliveries including Article 21 and 56

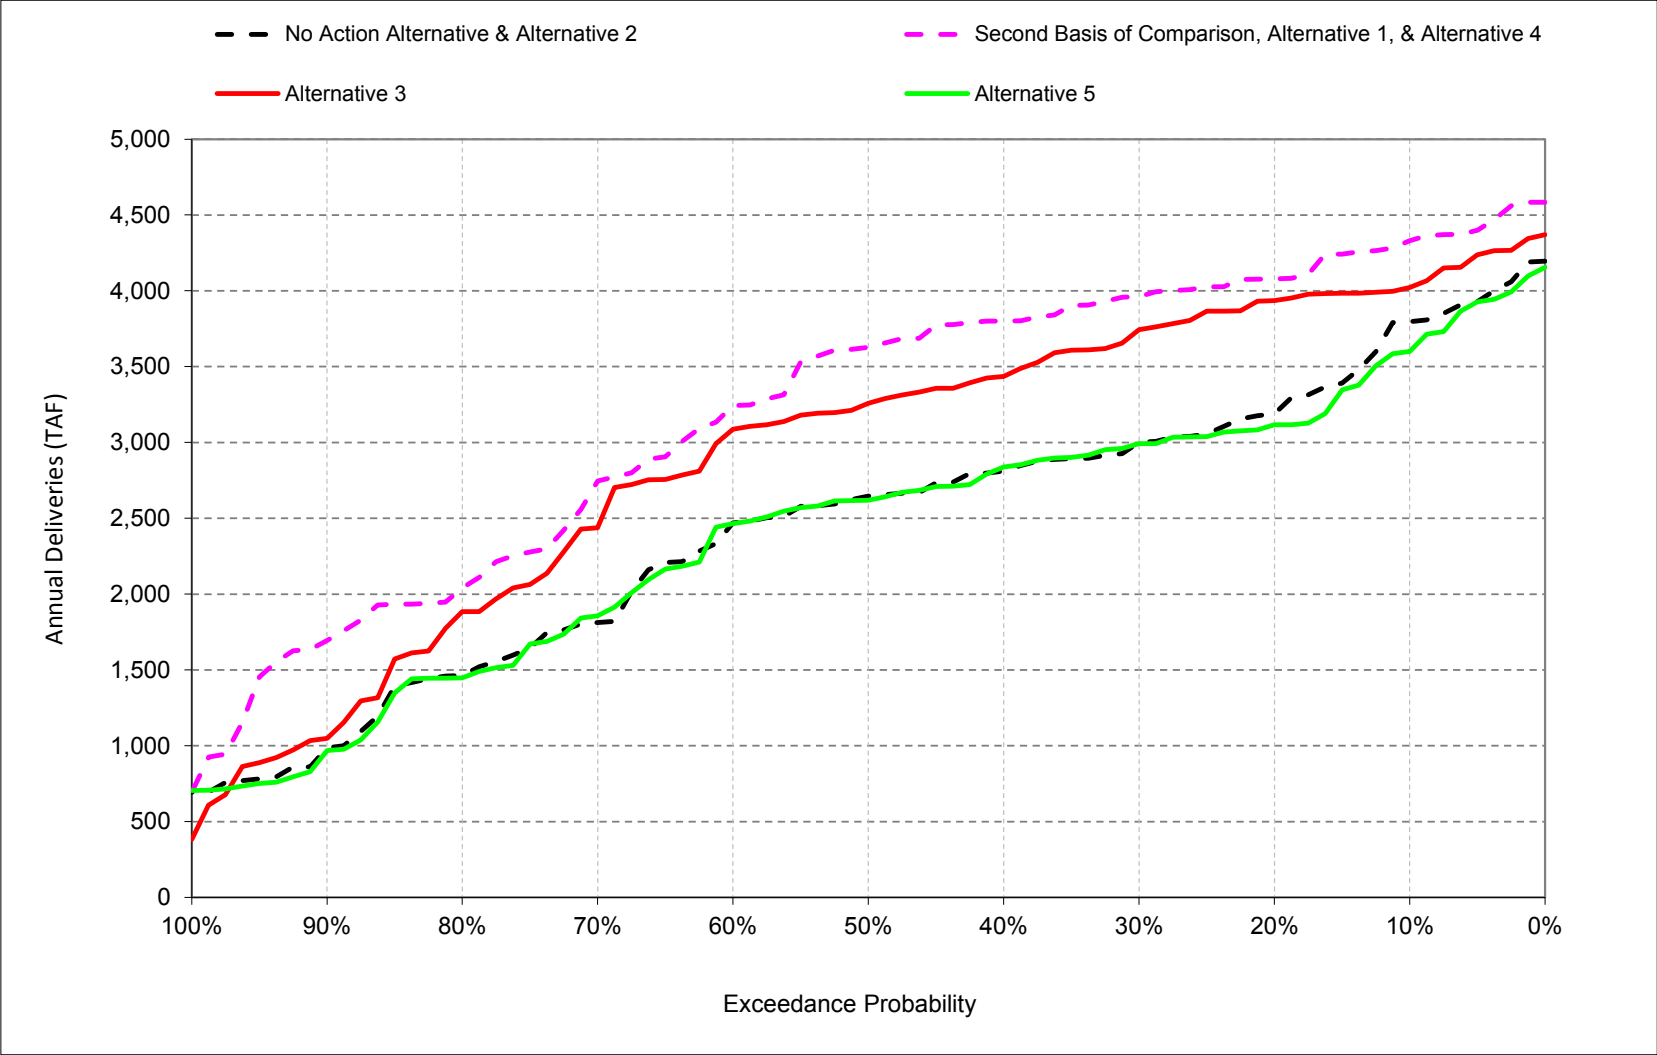


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 6) Annual deliveries are based on January to December average.

Figure C-20-1-3. Annual SWP Table A Deliveries with Article 56

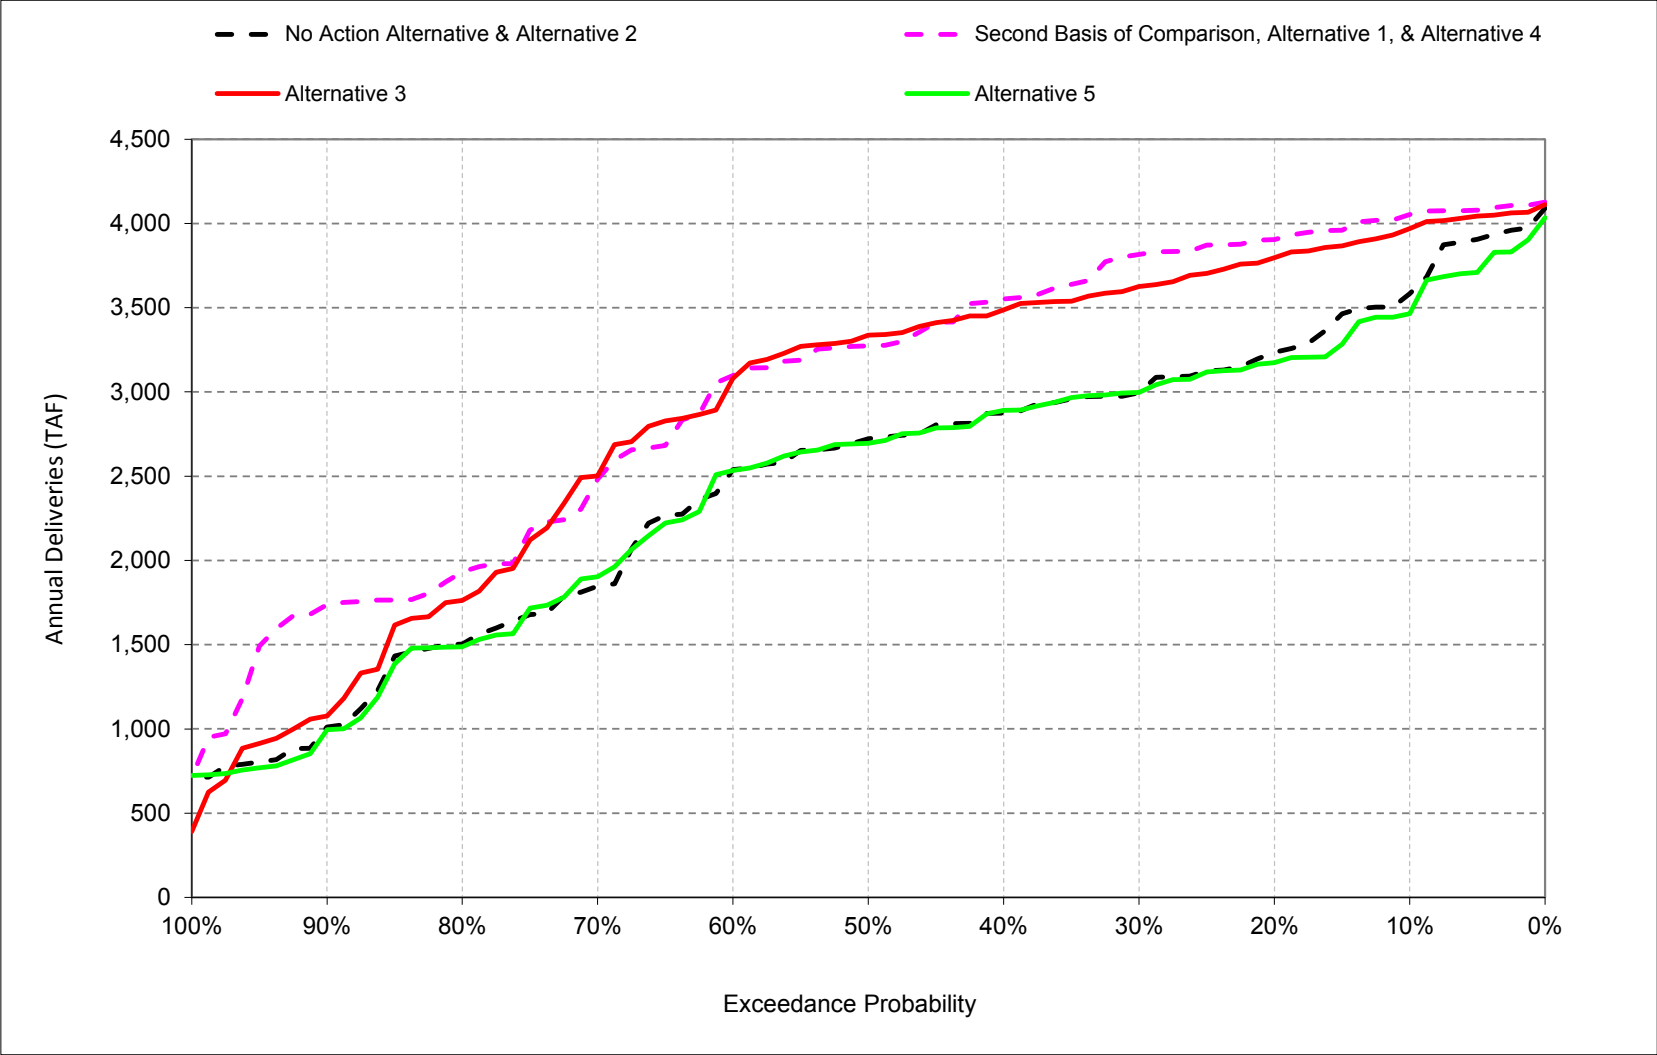


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 6) Annual deliveries are based on January to December average.

Figure C-20-1-4. Annual SWP South of Delta Table A Deliveries with Article 56

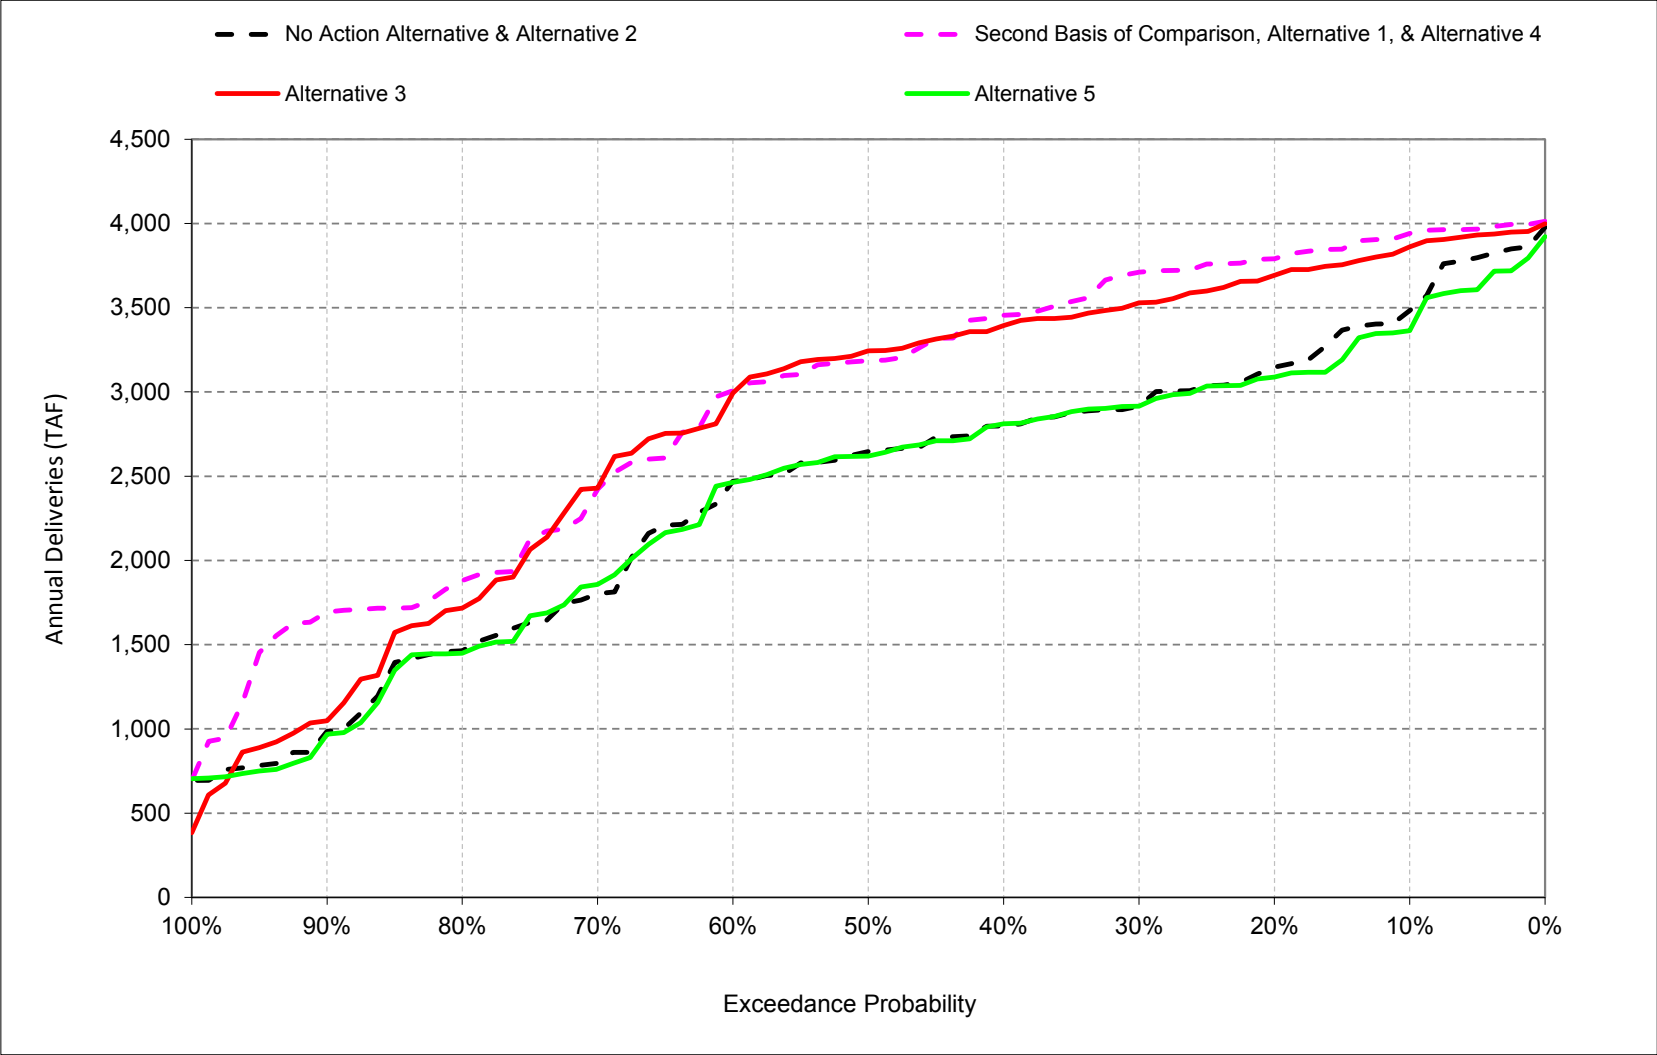

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 6) Annual deliveries are based on January to December average.

Figure C-20-1-5. Annual SWP Article 21 Deliveries

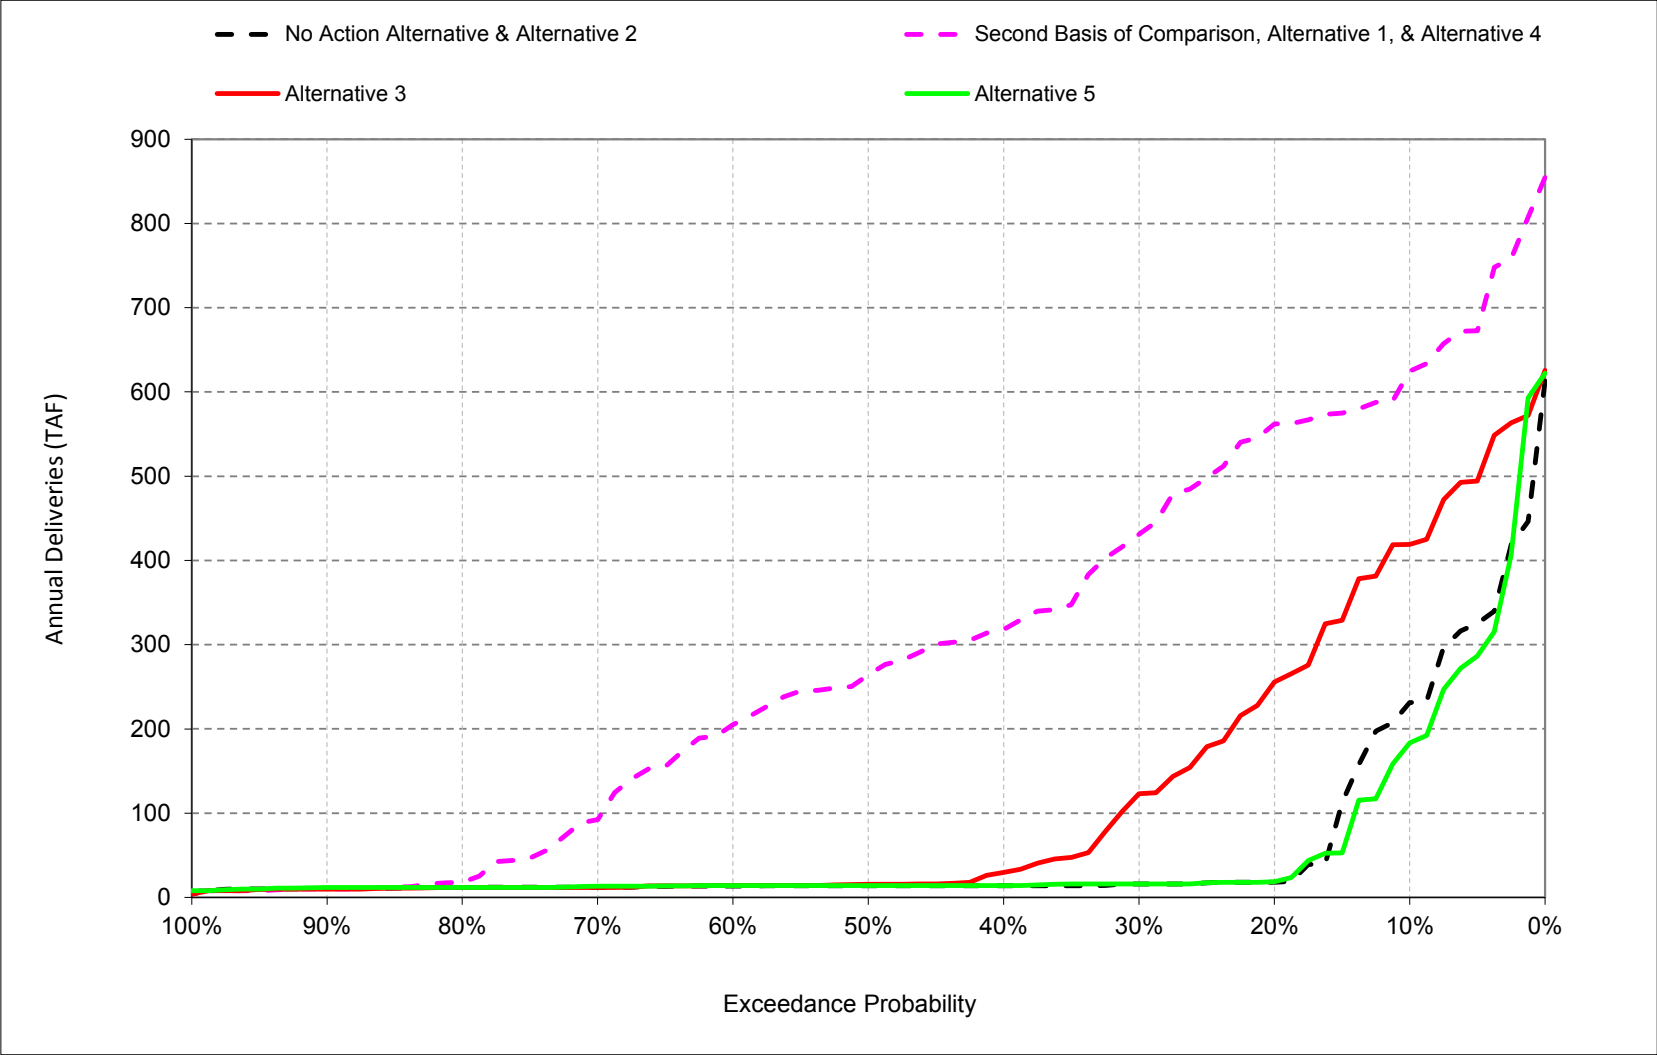

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 6) Annual deliveries are based on January to December average.

Appendix 5A: CalSim II and DSM2 Modeling Results

Table C-20-1-1. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, SWP

					Alternative 1	No Action Alternative	Alternative 1 minus No Action Alternative
Water Supply Reliability							
Sacramento River Hydrologic Region							
SWP FRSA	Contract Delivery (annual average)	(TAF/year)	Long Term	931	931	0	
			Dry	946	946	0	
			Critical	709	710	-1	
SWP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	27	22	5	
			Dry	19	16	3	
			Critical	12	9	3	
San Joaquin River Hydrologic Region							
SWP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	4	3	1	
			Dry	3	3	1	
			Critical	2	1	0	
San Francisco Bay Hydrologic Region							
SWP M&I (w/o Article 21)	Contract Delivery (includes transfers to SWP contractors) (annual average)	(TAF/year)	Long Term	220	181	39	
			Dry	167	137	30	
			Critical	103	76	27	
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	22	15	7	
			Dry	21	14	6	
			Critical	12	13	-1	
Central Coast Hydrologic Region							
SWP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	52	42	10	
			Dry	39	31	8	
			Critical	24	17	7	
Tulare Lake Hydrologic Region							
SWP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	99	81	18	
			Dry	75	60	15	
			Critical	46	33	14	
SWP Ag (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	736	599	137	
			Dry	557	447	110	
			Critical	340	246	94	
SWP Ag Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	176	26	150	
			Dry	141	5	136	
			Critical	28	10	18	
South Lahontan Hydrologic Region							
SWP M&I (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	325	266	59	
			Dry	253	204	50	
			Critical	156	115	41	
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	4	0	4	
			Dry	4	0	4	
			Critical	2	1	1	
South Coast Hydrologic Region							
SWP M&I (w/o Article 21)	Contract Delivery (includes transfers to SWP contractors) (annual average)	(TAF/year)	Long Term	1,544	1,276	268	
			Dry	1,240	1,008	232	
			Critical	792	563	229	
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	90	18	72	
			Dry	75	4	70	
			Critical	7	4	3	
SWP Ag (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	9	8	2	
			Dry	7	6	1	
			Critical	4	3	1	
SWP Ag Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	2	0	2	
			Dry	1	0	1	
			Critical	0	0	0	
Total For All Regions							
Total Supplies (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	3,947	3,409	537	
			Dry	3,308	2,858	450	
			Critical	2,189	1,773	415	
Total Article 21 Supplies	Contract Delivery (annual average)	(TAF/year)	Long Term	294	60	234	
			Dry	242	24	218	
			Critical	49	27	22	

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 6) Annual deliveries are based on January to December average.

Appendix 5A: CalSim II and DSM2 Modeling Results

Table C-20-1-2. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, SWP

				Alternative 1	No Action Alternative	Alternative 1 minus No Action Alternative
Water Supply Reliability						
North of Delta						
SWP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	0	0	0
			Dry	0	0	0
			Critical	0	0	0
SWP M&I (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	83	68	15
			Dry	62	51	11
			Critical	53	43	11
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	12	13	-1
			Dry	13	14	-1
			Critical	12	13	-1
Total SWP North of Delta						
Total SWP Ag and M&I NOD (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	83	68	15
			Dry	62	51	11
			Critical	53	43	11
Total SWP Ag and M&I Article 21 NOD	Contract Delivery (annual average)	(TAF/year)	Long Term	12	13	-1
			Dry	13	14	-1
			Critical	12	13	-1
South of Delta						
SWP Ag (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	750	610	139
			Dry	567	455	112
			Critical	484	378	106
SWP Ag Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	178	27	152
			Dry	143	5	138
			Critical	100	7	93
SWP M&I (w/o Article 21)	Contract Delivery (includes transfers to SWP contractors) (annual average)	(TAF/year)	Long Term	2,183	1,800	383
			Dry	1,732	1,406	327
			Critical	1,494	1,173	321
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	104	20	84
			Dry	86	5	82
			Critical	58	5	53
Total SWP South of Delta						
Total SWP Ag and M&I SOD (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	2,933	2,410	523
			Dry	2,299	1,861	439
			Critical	1,978	1,551	427
Total SWP Ag and M&I Article 21 SOD	Contract Delivery (annual average)	(TAF/year)	Long Term	282	47	236
			Dry	229	10	219
			Critical	158	12	146

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text. 6) Annual deliveries are based on January to December average.

Appendix 5A: CalSim II and DSM2 Modeling Results

Table C-20-2-1. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, SWP

					Alternative 3	No Action Alternative	Alternative 3 minus No Action Alternative
Water Supply Reliability							
Sacramento River Hydrologic Region							
SWP FRSA	Contract Delivery (annual average)	(TAF/year)	Long Term	932	931	1	
			Dry	946	946	0	
			Critical	721	710	10	
SWP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	25	22	4	
			Dry	18	16	3	
			Critical	9	9	0	
San Joaquin River Hydrologic Region							
SWP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	4	3	1	
			Dry	3	3	0	
			Critical	1	1	0	
San Francisco Bay Hydrologic Region							
SWP M&I (w/o Article 21)	Contract Delivery (includes transfers to SWP contractors) (annual average)	(TAF/year)	Long Term	211	181	30	
			Dry	160	137	23	
			Critical	77	76	1	
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	17	15	2	
			Dry	16	14	1	
			Critical	12	13	-1	
Central Coast Hydrologic Region							
SWP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	50	42	7	
			Dry	37	31	5	
			Critical	18	17	1	
Tulare Lake Hydrologic Region							
SWP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	95	81	14	
			Dry	71	60	11	
			Critical	35	33	2	
SWP Ag (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	703	599	104	
			Dry	523	447	76	
			Critical	253	246	8	
SWP Ag Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	72	26	46	
			Dry	36	5	31	
			Critical	13	10	3	
South Lahontan Hydrologic Region							
SWP M&I (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	312	266	46	
			Dry	240	204	36	
			Critical	118	115	4	
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	2	0	2	
			Dry	2	0	2	
			Critical	1	1	0	
South Coast Hydrologic Region							
SWP M&I (w/o Article 21)	Contract Delivery (includes transfers to SWP contractors) (annual average)	(TAF/year)	Long Term	1,493	1,276	216	
			Dry	1,182	1,008	174	
			Critical	596	563	33	
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	26	18	8	
			Dry	6	4	2	
			Critical	7	4	3	
SWP Ag (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	9	8	1	
			Dry	7	6	1	
			Critical	3	3	0	
SWP Ag Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	1	0	1	
			Dry	0	0	0	
			Critical	0	0	0	
Total For All Regions							
Total Supplies (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	3,834	3,409	425	
			Dry	3,187	2,858	329	
			Critical	1,832	1,773	58	
Total Article 21 Supplies	Contract Delivery (annual average)	(TAF/year)	Long Term	119	60	59	
			Dry	60	24	36	
			Critical	33	27	6	

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 6) Annual deliveries are based on January to December average.

Appendix 5A: CalSim II and DSM2 Modeling Results

Table C-20-2-2. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, SWP

				Alternative 3	No Action Alternative	Alternative 3 minus No Action Alternative
Water Supply Reliability						
North of Delta						
SWP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	0	0	0
			Dry	0	0	0
			Critical	0	0	0
SWP M&I (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	80	68	11
			Dry	60	51	8
			Critical	48	43	5
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	12	13	-1
			Dry	13	14	-1
			Critical	12	13	-1
Total SWP North of Delta						
Total SWP Ag and M&I NOD (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	80	68	11
			Dry	60	51	8
			Critical	48	43	5
Total SWP Ag and M&I Article 21 NOD	Contract Delivery (annual average)	(TAF/year)	Long Term	12	13	-1
			Dry	13	14	-1
			Critical	12	13	-1
South of Delta						
SWP Ag (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	716	610	106
			Dry	533	455	78
			Critical	430	378	52
SWP Ag Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	73	27	47
			Dry	36	5	31
			Critical	27	7	21
SWP M&I (w/o Article 21)	Contract Delivery (includes transfers to SWP contractors) (annual average)	(TAF/year)	Long Term	2,106	1,800	306
			Dry	1,649	1,406	243
			Critical	1,340	1,173	167
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	33	20	13
			Dry	11	5	6
			Critical	10	5	5
Total SWP South of Delta						
Total SWP Ag and M&I SOD (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	2,822	2,410	412
			Dry	2,182	1,861	321
			Critical	1,770	1,551	219
Total SWP Ag and M&I Article 21 SOD	Contract Delivery (annual average)	(TAF/year)	Long Term	106	47	60
			Dry	47	10	37
			Critical	38	12	26

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text. 6) Annual deliveries are based on January to December average.

Appendix 5A: CalSim II and DSM2 Modeling Results

Table C-20-3-1. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, SWP

					Alternative 5	No Action Alternative	Alternative 5 minus No Action Alternative
Water Supply Reliability							
Sacramento River Hydrologic Region							
SWP FRSA	Contract Delivery (annual average)	(TAF/year)	Long Term	932	931	1	
			Dry	946	946	0	
			Critical	717	710	6	
SWP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	21	22	0	
			Dry	16	16	0	
			Critical	9	9	0	
San Joaquin River Hydrologic Region							
SWP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	3	3	0	
			Dry	3	3	0	
			Critical	1	1	0	
San Francisco Bay Hydrologic Region							
SWP M&I (w/o Article 21)	Contract Delivery (includes transfers to SWP contractors) (annual average)	(TAF/year)	Long Term	178	181	-3	
			Dry	136	137	-1	
			Critical	74	76	-2	
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	15	15	0	
			Dry	15	14	1	
			Critical	12	13	0	
Central Coast Hydrologic Region							
SWP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	42	42	-1	
			Dry	31	31	0	
			Critical	17	17	-1	
Tulare Lake Hydrologic Region							
SWP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	80	81	-1	
			Dry	60	60	0	
			Critical	32	33	-1	
SWP Ag (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	588	599	-12	
			Dry	440	447	-6	
			Critical	233	246	-13	
SWP Ag Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	24	26	-2	
			Dry	6	5	1	
			Critical	0	10	-9	
South Lahontan Hydrologic Region							
SWP M&I (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	263	266	-3	
			Dry	203	204	-1	
			Critical	109	115	-6	
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	0	0	0	
			Dry	0	0	0	
			Critical	0	1	-1	
South Coast Hydrologic Region							
SWP M&I (w/o Article 21)	Contract Delivery (includes transfers to SWP contractors) (annual average)	(TAF/year)	Long Term	1,268	1,276	-8	
			Dry	1,002	1,008	-6	
			Critical	545	563	-18	
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	17	18	-1	
			Dry	4	4	0	
			Critical	0	4	-4	
SWP Ag (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	7	8	0	
			Dry	6	6	0	
			Critical	3	3	0	
SWP Ag Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	0	0	0	
			Dry	0	0	0	
			Critical	0	0	0	
Total For All Regions							
Total Supplies (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	3,382	3,409	-27	
			Dry	2,842	2,858	-16	
			Critical	1,739	1,773	-35	
Total Article 21 Supplies	Contract Delivery (annual average)	(TAF/year)	Long Term	56	60	-3	
			Dry	25	24	2	
			Critical	13	27	-14	

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 6) Annual deliveries are based on January to December average.

Appendix 5A: CalSim II and DSM2 Modeling Results

Table C-20-3-2. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, SWP

				Alternative 5	No Action Alternative	Alternative 5 minus No Action Alternative
Water Supply Reliability						
North of Delta						
SWP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	0	0	0
			Dry	0	0	0
			Critical	0	0	0
SWP M&I (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	67	68	-1
			Dry	51	51	0
			Critical	42	43	-1
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	13	13	0
			Dry	14	14	1
			Critical	13	13	1
Total SWP North of Delta						
Total SWP Ag and M&I NOD (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	67	68	-1
			Dry	51	51	0
			Critical	42	43	-1
Total SWP Ag and M&I Article 21 NOD	Contract Delivery (annual average)	(TAF/year)	Long Term	13	13	0
			Dry	14	14	1
			Critical	13	13	1
South of Delta						
SWP Ag (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	598	610	-12
			Dry	449	455	-7
			Critical	369	378	-9
SWP Ag Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	24	27	-2
			Dry	6	5	1
			Critical	4	7	-3
SWP M&I (w/o Article 21)	Contract Delivery (includes transfers to SWP contractors) (annual average)	(TAF/year)	Long Term	1,784	1,800	-15
			Dry	1,397	1,406	-9
			Critical	1,157	1,173	-16
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	19	20	-1
			Dry	5	5	0
			Critical	3	5	-2
Total SWP South of Delta						
Total SWP Ag and M&I SOD (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	2,383	2,410	-27
			Dry	1,845	1,861	-15
			Critical	1,526	1,551	-25
Total SWP Ag and M&I Article 21 SOD	Contract Delivery (annual average)	(TAF/year)	Long Term	43	47	-4
			Dry	11	10	1
			Critical	7	12	-5

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text. 6) Annual deliveries are based on January to December average.

Appendix 5A: CalSim II and DSM2 Modeling Results

Table C-20-4-1. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, SWP

				No Action Alternative	Second Basis of Comparison	No Action Alternative minus Second Basis of Comparison
Water Supply Reliability						
Sacramento River Hydrologic Region						
SWP FRSA	Contract Delivery (annual average)	(TAF/year)	Long Term	931	931	0
			Dry	946	946	0
			Critical	710	709	1
SWP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	22	27	-5
			Dry	16	19	-3
			Critical	9	12	-3
San Joaquin River Hydrologic Region						
SWP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	3	4	-1
			Dry	3	3	-1
			Critical	1	2	0
San Francisco Bay Hydrologic Region						
SWP M&I (w/o Article 21)	Contract Delivery (includes transfers to SWP contractors) (annual average)	(TAF/year)	Long Term	181	220	-39
			Dry	137	167	-30
			Critical	76	103	-27
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	15	22	-7
			Dry	14	21	-6
			Critical	13	12	1
Central Coast Hydrologic Region						
SWP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	42	52	-10
			Dry	31	39	-8
			Critical	17	24	-7
Tulare Lake Hydrologic Region						
SWP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	81	99	-18
			Dry	60	75	-15
			Critical	33	46	-14
SWP Ag (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	599	736	-137
			Dry	447	557	-110
			Critical	246	340	-94
SWP Ag Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	26	176	-150
			Dry	5	141	-136
			Critical	10	28	-18
South Lahontan Hydrologic Region						
SWP M&I (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	266	325	-59
			Dry	204	253	-50
			Critical	115	156	-41
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	0	4	-4
			Dry	0	4	-4
			Critical	1	2	-1
South Coast Hydrologic Region						
SWP M&I (w/o Article 21)	Contract Delivery (includes transfers to SWP contractors) (annual average)	(TAF/year)	Long Term	1,276	1,544	-268
			Dry	1,008	1,240	-232
			Critical	563	792	-229
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	18	90	-72
			Dry	4	75	-70
			Critical	4	7	-3
SWP Ag (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	8	9	-2
			Dry	6	7	-1
			Critical	3	4	-1
SWP Ag Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	0	2	-2
			Dry	0	1	-1
			Critical	0	0	0
Total For All Regions						
Total Supplies (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	3,409	3,947	-537
			Dry	2,858	3,308	-450
			Critical	1,773	2,189	-415
Total Article 21 Supplies	Contract Delivery (annual average)	(TAF/year)	Long Term	60	294	-234
			Dry	24	242	-218
			Critical	27	49	-22

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 6) Annual deliveries are based on January to December average.

Appendix 5A: CalSim II and DSM2 Modeling Results

Table C-20-4-2. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, SWP

				No Action Alternative	Second Basis of Comparison	No Action Alternative minus Second Basis of Comparison
Water Supply Reliability						
North of Delta						
SWP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	0	0	0
			Dry	0	0	0
			Critical	0	0	0
SWP M&I (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	68	83	-15
			Dry	51	62	-11
			Critical	43	53	-11
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	13	12	1
			Dry	14	13	1
			Critical	13	12	1
Total SWP North of Delta						
Total SWP Ag and M&I NOD (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	68	83	-15
			Dry	51	62	-11
			Critical	43	53	-11
Total SWP Ag and M&I Article 21 NOD	Contract Delivery (annual average)	(TAF/year)	Long Term	13	12	1
			Dry	14	13	1
			Critical	13	12	1
South of Delta						
SWP Ag (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	610	750	-139
			Dry	455	567	-112
			Critical	378	484	-106
SWP Ag Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	27	178	-152
			Dry	5	143	-138
			Critical	7	100	-93
SWP M&I (w/o Article 21)	Contract Delivery (includes transfers to SWP contractors) (annual average)	(TAF/year)	Long Term	1,800	2,183	-383
			Dry	1,406	1,732	-327
			Critical	1,173	1,494	-321
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	20	104	-84
			Dry	5	86	-82
			Critical	5	58	-53
Total SWP South of Delta						
Total SWP Ag and M&I SOD (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	2,410	2,933	-523
			Dry	1,861	2,299	-439
			Critical	1,551	1,978	-427
Total SWP Ag and M&I Article 21 SOD	Contract Delivery (annual average)	(TAF/year)	Long Term	47	282	-236
			Dry	10	229	-219
			Critical	12	158	-146

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text. 6) Annual deliveries are based on January to December average.

Appendix 5A: CalSim II and DSM2 Modeling Results

Table C-20-5-1. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, SWP

				Alternative 3	Second Basis of Comparison	Alternative 3 minus Second Basis of Comparison
Water Supply Reliability						
Sacramento River Hydrologic Region						
SWP FRSA	Contract Delivery (annual average)	(TAF/year)	Long Term	932	931	2
			Dry	946	946	0
			Critical	721	709	11
SWP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	25	27	-1
			Dry	18	19	-1
			Critical	9	12	-3
San Joaquin River Hydrologic Region						
SWP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	4	4	0
			Dry	3	3	0
			Critical	1	2	0
San Francisco Bay Hydrologic Region						
SWP M&I (w/o Article 21)	Contract Delivery (includes transfers to SWP contractors) (annual average)	(TAF/year)	Long Term	211	220	-8
			Dry	160	167	-7
			Critical	77	103	-26
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	17	22	-5
			Dry	16	21	-5
			Critical	12	12	0
Central Coast Hydrologic Region						
SWP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	50	52	-2
			Dry	37	39	-2
			Critical	18	24	-6
Tulare Lake Hydrologic Region						
SWP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	95	99	-4
			Dry	71	75	-4
			Critical	35	46	-12
SWP Ag (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	703	736	-33
			Dry	523	557	-33
			Critical	253	340	-86
SWP Ag Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	72	176	-104
			Dry	36	141	-106
			Critical	13	28	-15
South Lahontan Hydrologic Region						
SWP M&I (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	312	325	-13
			Dry	240	253	-14
			Critical	118	156	-38
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	2	4	-1
			Dry	2	4	-2
			Critical	1	2	-1
South Coast Hydrologic Region						
SWP M&I (w/o Article 21)	Contract Delivery (includes transfers to SWP contractors) (annual average)	(TAF/year)	Long Term	1,493	1,544	-51
			Dry	1,182	1,240	-59
			Critical	596	792	-196
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	26	90	-64
			Dry	6	75	-68
			Critical	7	7	0
SWP Ag (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	9	9	0
			Dry	7	7	0
			Critical	3	4	-1
SWP Ag Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	1	2	-1
			Dry	0	1	-1
			Critical	0	0	0
Total For All Regions						
Total Supplies (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	3,834	3,947	-113
			Dry	3,187	3,308	-120
			Critical	1,832	2,189	-357
Total Article 21 Supplies	Contract Delivery (annual average)	(TAF/year)	Long Term	119	294	-175
			Dry	60	242	-182
			Critical	33	49	-16

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 6) Annual deliveries are based on January to December average.

Appendix 5A: CalSim II and DSM2 Modeling Results

Table C-20-5-2. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, SWP

				Alternative 3	Second Basis of Comparison	Alternative 3 minus Second Basis of Comparison
Water Supply Reliability						
North of Delta						
SWP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	0	0	0
			Dry	0	0	0
			Critical	0	0	0
SWP M&I (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	80	83	-3
			Dry	60	62	-3
			Critical	48	53	-5
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	12	12	1
			Dry	13	13	0
			Critical	12	12	0
Total SWP North of Delta						
Total SWP Ag and M&I NOD (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	80	83	-3
			Dry	60	62	-3
			Critical	48	53	-5
Total SWP Ag and M&I Article 21 NOD	Contract Delivery (annual average)	(TAF/year)	Long Term	12	12	1
			Dry	13	13	0
			Critical	12	12	0
South of Delta						
SWP Ag (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	716	750	-34
			Dry	533	567	-34
			Critical	430	484	-54
SWP Ag Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	73	178	-105
			Dry	36	143	-107
			Critical	27	100	-72
SWP M&I (w/o Article 21)	Contract Delivery (includes transfers to SWP contractors) (annual average)	(TAF/year)	Long Term	2,106	2,183	-77
			Dry	1,649	1,732	-84
			Critical	1,340	1,494	-154
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	33	104	-71
			Dry	11	86	-75
			Critical	10	58	-48
Total SWP South of Delta						
Total SWP Ag and M&I SOD (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	2,822	2,933	-111
			Dry	2,182	2,299	-118
			Critical	1,770	1,978	-208
Total SWP Ag and M&I Article 21 SOD	Contract Delivery (annual average)	(TAF/year)	Long Term	106	282	-176
			Dry	47	229	-182
			Critical	38	158	-120

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text. 6) Annual deliveries are based on January to December average.

Appendix 5A: CalSim II and DSM2 Modeling Results

Table C-20-6-1. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, SWP

				Alternative 5	Second Basis of Comparison	Alternative 5 minus Second Basis of Comparison
Water Supply Reliability						
Sacramento River Hydrologic Region						
SWP FRSA	Contract Delivery (annual average)	(TAF/year)	Long Term	932	931	1
			Dry	946	946	0
			Critical	717	709	7
SWP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	21	27	-5
			Dry	16	19	-3
			Critical	9	12	-3
San Joaquin River Hydrologic Region						
SWP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	3	4	-1
			Dry	3	3	-1
			Critical	1	2	0
San Francisco Bay Hydrologic Region						
SWP M&I (w/o Article 21)	Contract Delivery (includes transfers to SWP contractors) (annual average)	(TAF/year)	Long Term	178	220	-42
			Dry	136	167	-31
			Critical	74	103	-30
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	15	22	-7
			Dry	15	21	-6
			Critical	12	12	1
Central Coast Hydrologic Region						
SWP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	42	52	-10
			Dry	31	39	-8
			Critical	17	24	-8
Tulare Lake Hydrologic Region						
SWP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	80	99	-20
			Dry	60	75	-16
			Critical	32	46	-15
SWP Ag (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	588	736	-148
			Dry	440	557	-116
			Critical	233	340	-107
SWP Ag Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	24	176	-152
			Dry	6	141	-135
			Critical	0	28	-27
South Lahontan Hydrologic Region						
SWP M&I (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	263	325	-63
			Dry	203	253	-51
			Critical	109	156	-47
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	0	4	-4
			Dry	0	4	-4
			Critical	0	2	-2
South Coast Hydrologic Region						
SWP M&I (w/o Article 21)	Contract Delivery (includes transfers to SWP contractors) (annual average)	(TAF/year)	Long Term	1,268	1,544	-276
			Dry	1,002	1,240	-238
			Critical	545	792	-247
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	17	90	-73
			Dry	4	75	-70
			Critical	0	7	-7
SWP Ag (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	7	9	-2
			Dry	6	7	-1
			Critical	3	4	-1
SWP Ag Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	0	2	-2
			Dry	0	1	-1
			Critical	0	0	0
Total For All Regions						
Total Supplies (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	3,382	3,947	-565
			Dry	2,842	3,308	-465
			Critical	1,739	2,189	-450
Total Article 21 Supplies	Contract Delivery (annual average)	(TAF/year)	Long Term	56	294	-238
			Dry	25	242	-217
			Critical	13	49	-36

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 6) Annual deliveries are based on January to December average.

Appendix 5A: CalSim II and DSM2 Modeling Results


Table C-20-6-2. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, SWP

				Alternative 5	Second Basis of Comparison	Alternative 5 minus Second Basis of Comparison
Water Supply Reliability						
North of Delta						
SWP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	0	0	0
			Dry	0	0	0
			Critical	0	0	0
SWP M&I (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	67	83	-16
			Dry	51	62	-11
			Critical	42	53	-11
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	13	12	2
			Dry	14	13	1
			Critical	13	12	2
Total SWP North of Delta						
Total SWP Ag and M&I NOD (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	67	83	-16
			Dry	51	62	-11
			Critical	42	53	-11
Total SWP Ag and M&I Article 21 NOD	Contract Delivery (annual average)	(TAF/year)	Long Term	13	12	2
			Dry	14	13	1
			Critical	13	12	2
South of Delta						
SWP Ag (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	598	750	-151
			Dry	449	567	-118
			Critical	369	484	-115
SWP Ag Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	24	178	-154
			Dry	6	143	-137
			Critical	4	100	-96
SWP M&I (w/o Article 21)	Contract Delivery (includes transfers to SWP contractors) (annual average)	(TAF/year)	Long Term	1,784	2,183	-399
			Dry	1,397	1,732	-336
			Critical	1,157	1,494	-337
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	19	104	-85
			Dry	5	86	-81
			Critical	3	58	-55
Total SWP South of Delta						
Total SWP Ag and M&I SOD (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	2,383	2,933	-550
			Dry	1,845	2,299	-454
			Critical	1,526	1,978	-451
Total SWP Ag and M&I Article 21 SOD	Contract Delivery (annual average)	(TAF/year)	Long Term	43	282	-239
			Dry	11	229	-218
			Critical	7	158	-151

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text. 6) Annual deliveries are based on January to December average.

1 **C.21. Trinity River Flow below Lewiston**


Figure C-21-1. Trinity River below Lewiston Reservoir, Long-Term* Average Flow

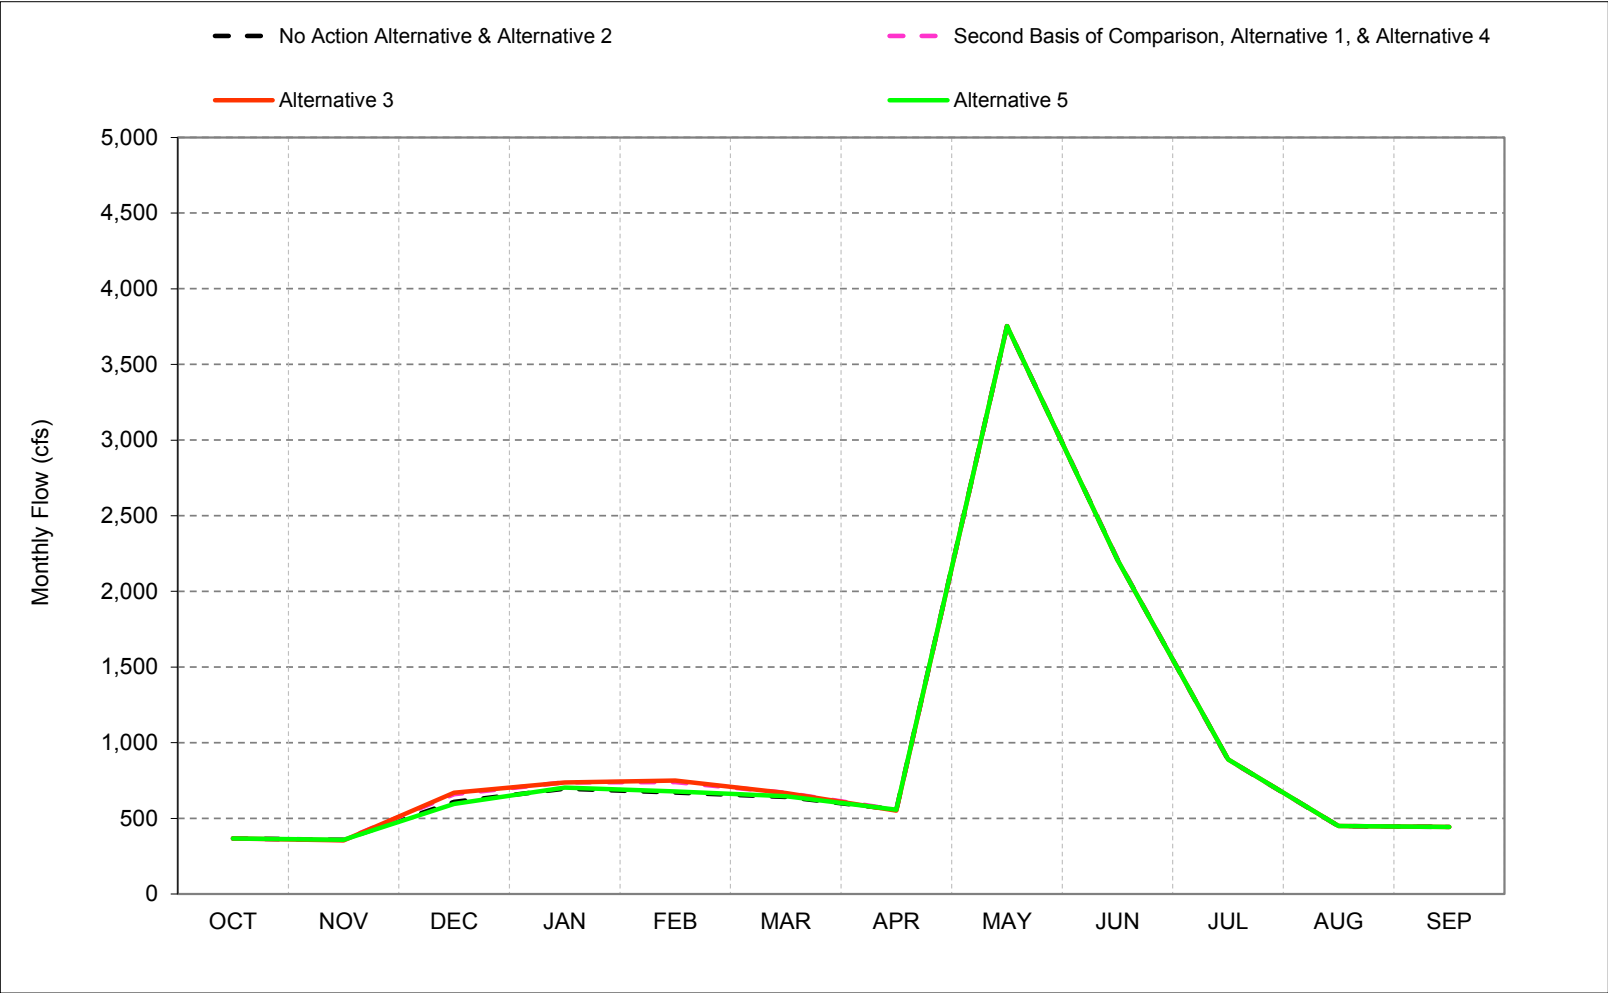

*Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-21-2. Trinity River below Lewiston Reservoir, Wet Year* Long-Term** Average Flow

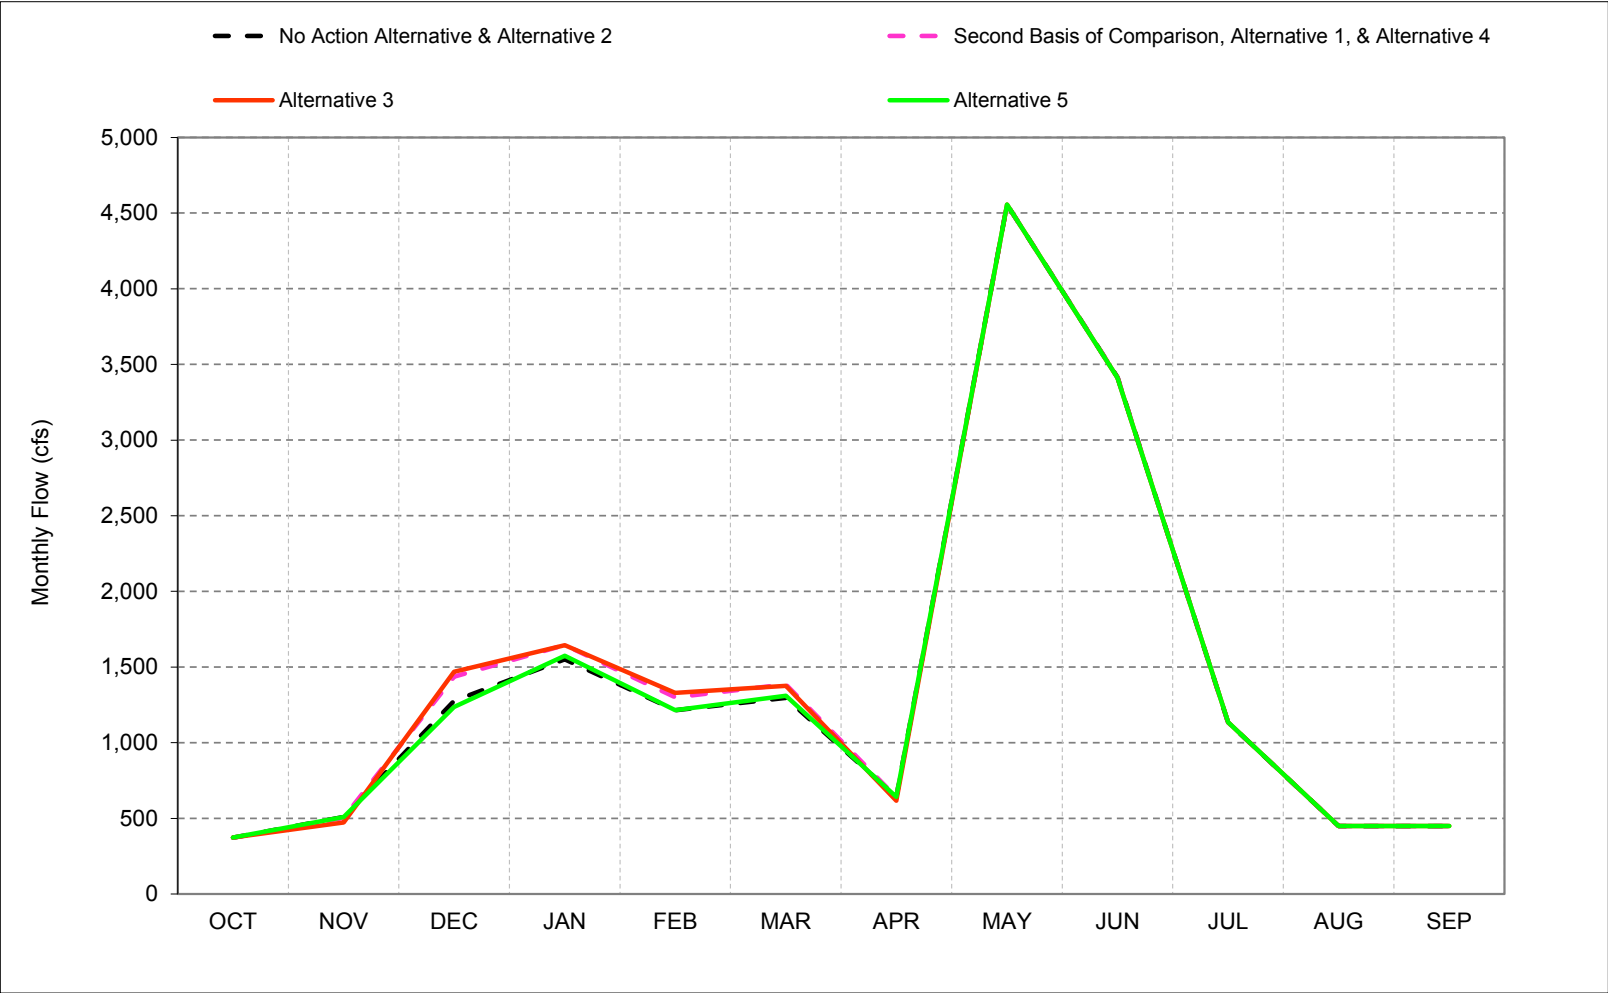


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-21-3. Trinity River below Lewiston Reservoir, Above Normal Year* Long-Term** Average Flow

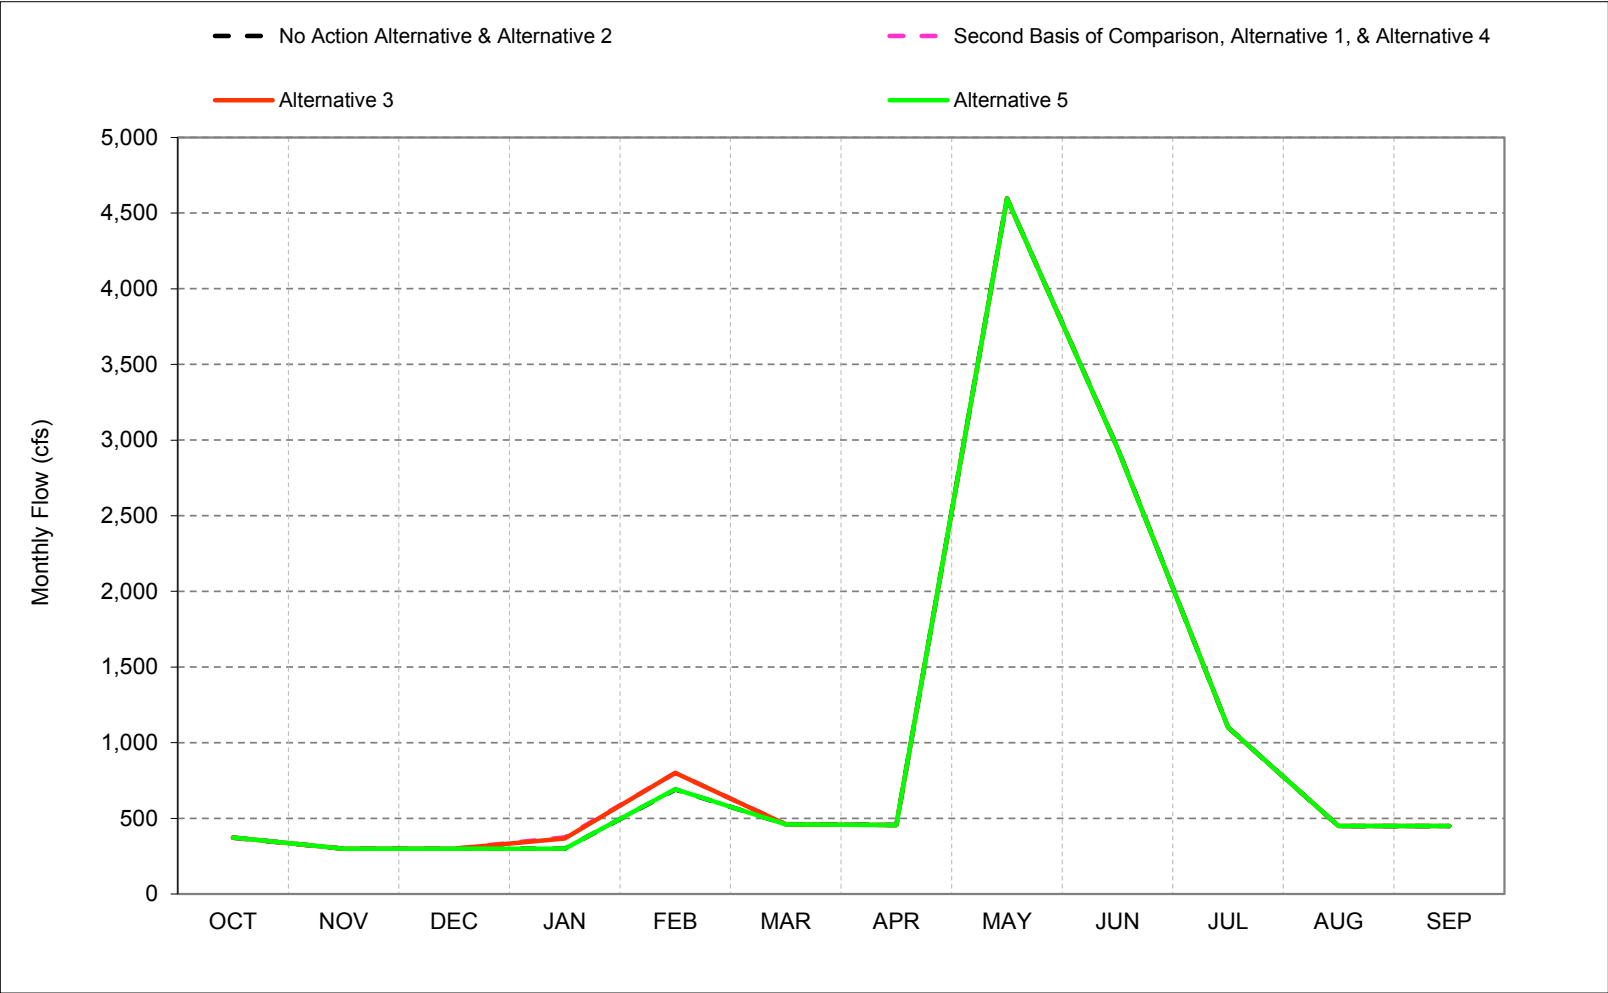


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-21-4. Trinity River below Lewiston Reservoir, Below Normal Year* Long-Term** Average Flow

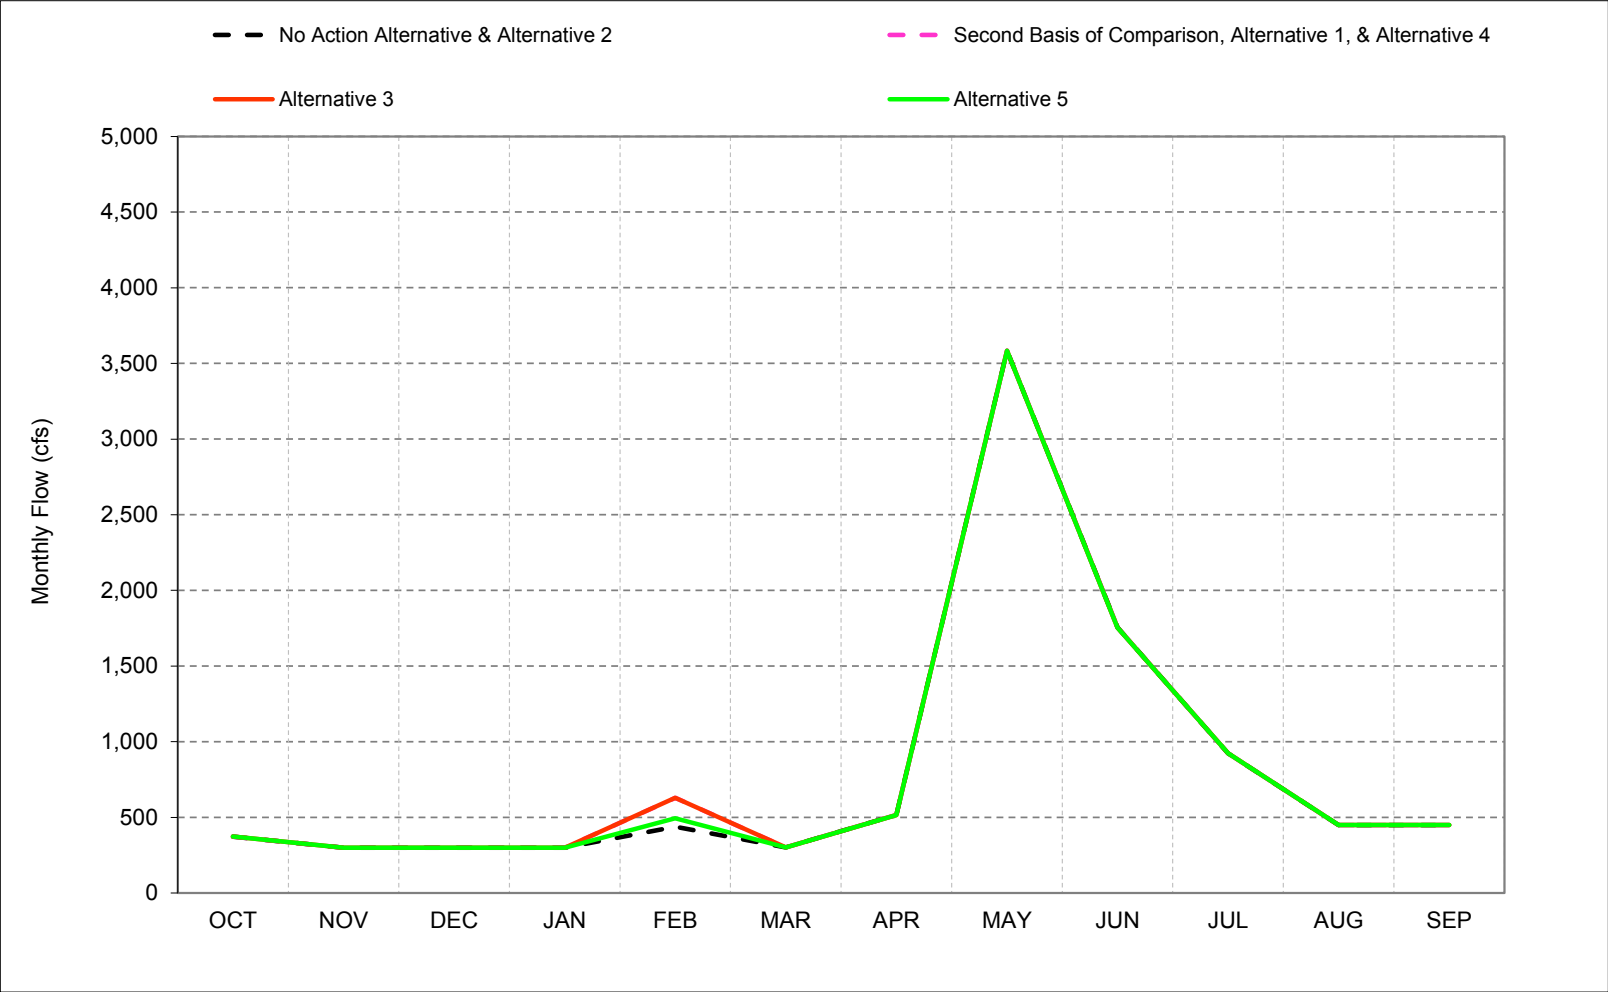


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-21-5. Trinity River below Lewiston Reservoir, Dry Year* Long-Term** Average Flow

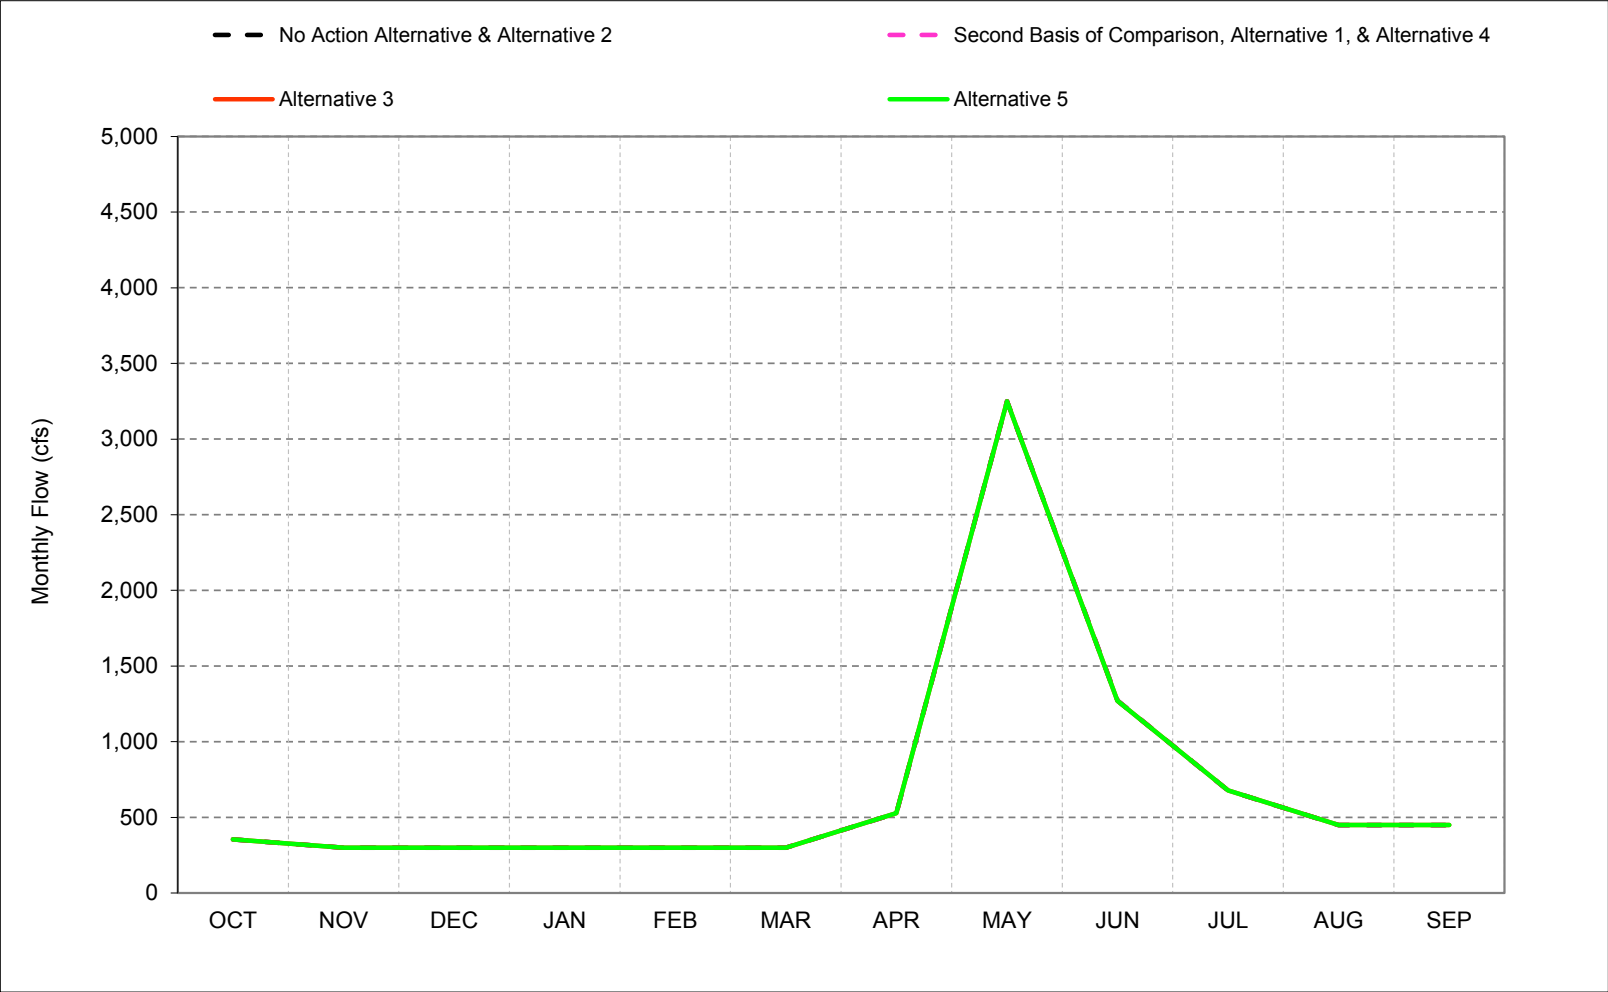


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-21-6. Trinity River below Lewiston Reservoir, Critical Year* Long-Term** Average Flow

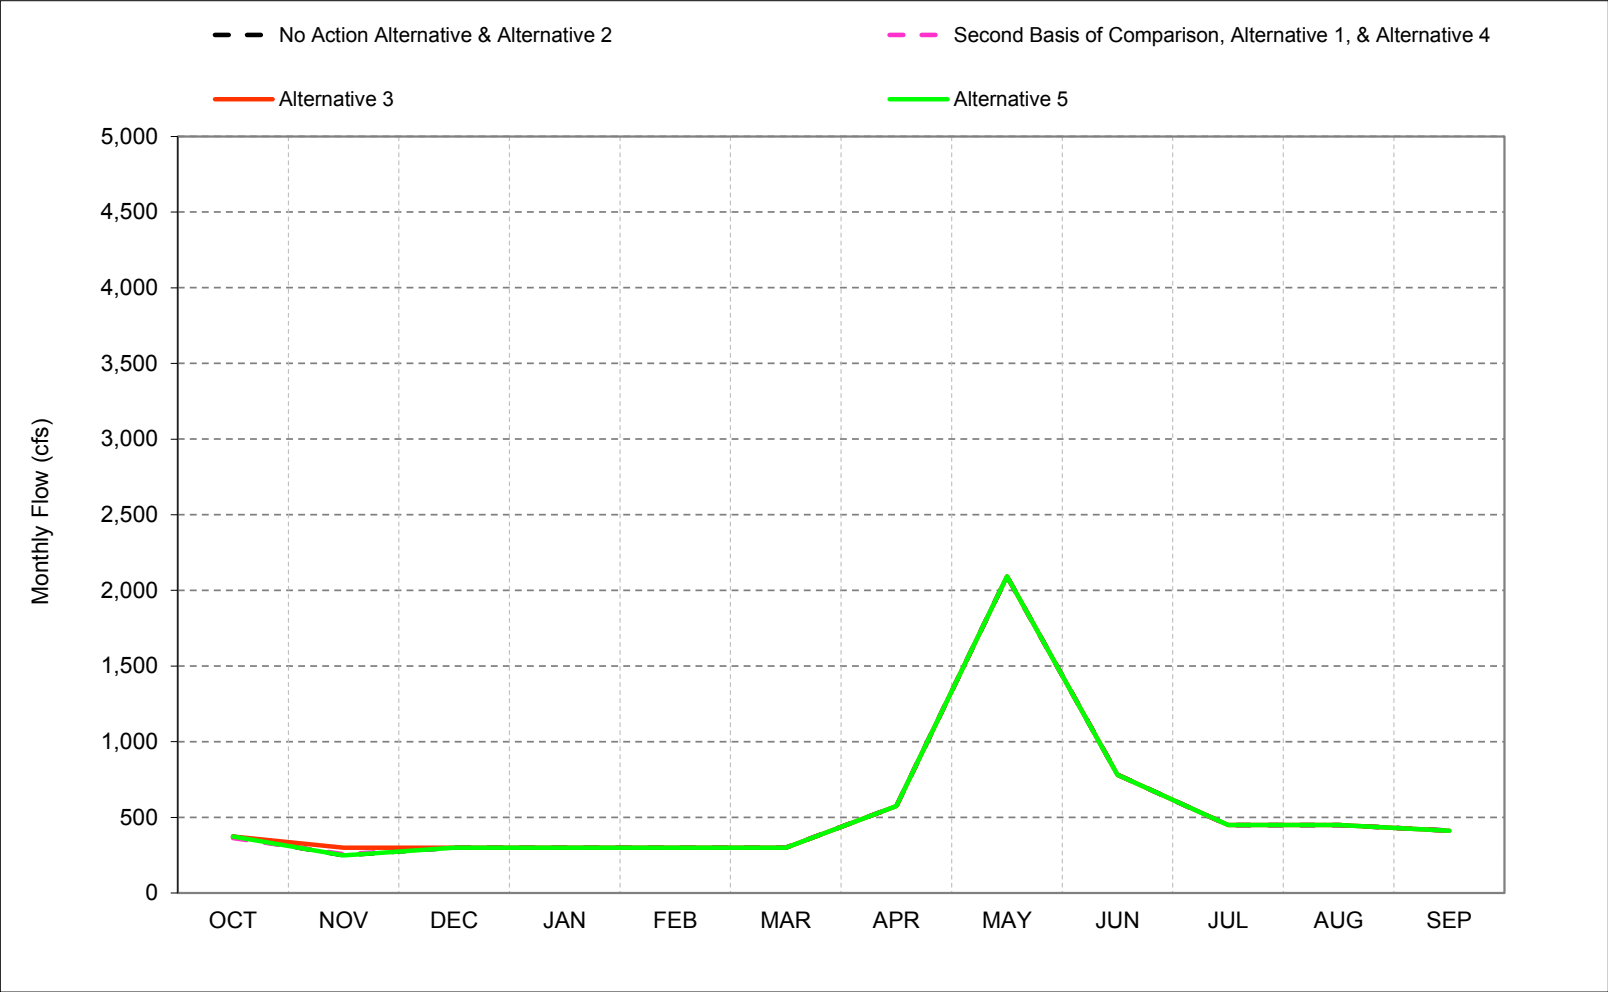

*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-21-1. Trinity River below Lewiston Reservoir, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	373	300	300	552	1,240	328	600	4,709	4,626	1,102	450	450
20%	373	300	300	300	300	300	540	4,709	2,526	1,102	450	450
30%	373	300	300	300	300	300	540	4,570	2,526	1,102	450	450
40%	373	300	300	300	300	300	521	4,570	2,526	1,102	450	450
50%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
60%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
70%	373	300	300	300	300	300	460	2,924	783	450	450	450
80%	373	300	300	300	300	300	460	2,924	783	450	450	450
90%	373	300	300	300	300	300	427	1,498	783	450	450	450
Long Term												
Full Simulation Period ^b	368	359	610	697	671	642	559	3,753	2,210	890	450	445
Water Year Types^c												
Wet (32%)	373	510	1,277	1,552	1,215	1,297	643	4,556	3,413	1,136	450	450
Above Normal (16%)	373	300	300	300	691	462	457	4,597	2,948	1,102	450	450
Below Normal (13%)	373	300	300	300	438	303	517	3,585	1,755	924	450	450
Dry (24%)	354	300	300	300	300	300	528	3,250	1,271	678	450	450
Critical (15%)	373	250	300	300	300	300	575	2,092	783	450	450	413

Alternative 1												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	373	300	300	1,448	2,106	527	600	4,709	4,626	1,102	450	450
20%	373	300	300	300	300	300	540	4,709	2,526	1,102	450	450
30%	373	300	300	300	300	300	540	4,570	2,526	1,102	450	450
40%	373	300	300	300	300	300	521	4,570	2,526	1,102	450	450
50%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
60%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
70%	373	300	300	300	300	300	460	2,924	783	450	450	450
80%	373	300	300	300	300	300	460	2,924	783	450	450	450
90%	373	300	300	300	300	300	427	1,498	783	450	450	450
Long Term												
Full Simulation Period ^b	367	358	660	739	741	670	557	3,753	2,210	890	450	445
Water Year Types^c												
Wet (32%)	373	504	1,437	1,646	1,300	1,386	639	4,556	3,413	1,136	450	450
Above Normal (16%)	373	300	300	374	801	462	457	4,597	2,948	1,102	450	450
Below Normal (13%)	373	300	300	300	630	303	517	3,585	1,755	924	450	450
Dry (24%)	354	300	300	300	300	300	528	3,250	1,271	678	450	450
Critical (15%)	364	257	300	300	300	300	575	2,092	783	450	450	413

Alternative 1 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	896	866	198	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	-1	-1	51	42	70	28	-1	0	0	0	0	0
Water Year Types^c												
Wet (32%)	0	-6	160	94	86	89	-4	0	0	0	0	0
Above Normal (16%)	0	0	0	74	110	0	0	0	0	0	0	0
Below Normal (13%)	0	0	0	0	192	0	0	0	0	0	0	0
Dry (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (15%)	-9	7	0	0	0	0	0	0	0	0	0	0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-21-2. Trinity River below Lewiston Reservoir, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	373	300	300	552	1,240	328	600	4,709	4,626	1,102	450	450
20%	373	300	300	300	300	300	540	4,709	2,526	1,102	450	450
30%	373	300	300	300	300	300	540	4,570	2,526	1,102	450	450
40%	373	300	300	300	300	300	521	4,570	2,526	1,102	450	450
50%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
60%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
70%	373	300	300	300	300	300	460	2,924	783	450	450	450
80%	373	300	300	300	300	300	460	2,924	783	450	450	450
90%	373	300	300	300	300	300	427	1,498	783	450	450	450
Long Term												
Full Simulation Period ^b	368	359	610	697	671	642	559	3,753	2,210	890	450	445
Water Year Types^c												
Wet (32%)	373	510	1,277	1,552	1,215	1,297	643	4,556	3,413	1,136	450	450
Above Normal (16%)	373	300	300	300	691	462	457	4,597	2,948	1,102	450	450
Below Normal (13%)	373	300	300	300	438	303	517	3,585	1,755	924	450	450
Dry (24%)	354	300	300	300	300	300	528	3,250	1,271	678	450	450
Critical (15%)	373	250	300	300	300	300	575	2,092	783	450	450	413

Alternative 3												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	373	300	300	1,439	2,157	328	600	4,709	4,626	1,102	450	450
20%	373	300	300	300	300	300	540	4,709	2,526	1,102	450	450
30%	373	300	300	300	300	300	540	4,570	2,526	1,102	450	450
40%	373	300	300	300	300	300	493	4,570	2,526	1,102	450	450
50%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
60%	373	300	300	300	300	300	473	4,189	2,120	1,102	450	450
70%	373	300	300	300	300	300	460	2,924	783	450	450	450
80%	373	300	300	300	300	300	460	2,924	783	450	450	450
90%	373	300	300	300	300	300	427	1,498	783	450	450	450
Long Term												
Full Simulation Period ^b	368	355	671	737	750	667	551	3,753	2,210	890	450	445
Water Year Types^c												
Wet (32%)	373	474	1,469	1,645	1,329	1,376	618	4,556	3,413	1,136	450	450
Above Normal (16%)	373	300	300	367	801	462	457	4,597	2,948	1,102	450	450
Below Normal (13%)	373	300	300	300	630	303	517	3,585	1,755	924	450	450
Dry (24%)	354	300	300	300	300	300	528	3,250	1,271	678	450	450
Critical (15%)	373	300	300	300	300	300	575	2,092	783	450	450	413

Alternative 3 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	887	916	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	-28	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	-20	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	-4	61	40	79	25	-8	0	0	0	0	0
Water Year Types^c												
Wet (32%)	0	-36	193	93	114	79	-26	0	0	0	0	0
Above Normal (16%)	0	0	0	67	110	0	0	0	0	0	0	0
Below Normal (13%)	0	0	0	0	192	0	0	0	0	0	0	0
Dry (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (15%)	0	50	0	0	0	0	0	0	0	0	0	0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-21-3. Trinity River below Lewiston Reservoir, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	373	300	300	552	1,240	328	600	4,709	4,626	1,102	450	450
20%	373	300	300	300	300	300	540	4,709	2,526	1,102	450	450
30%	373	300	300	300	300	300	540	4,570	2,526	1,102	450	450
40%	373	300	300	300	300	300	521	4,570	2,526	1,102	450	450
50%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
60%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
70%	373	300	300	300	300	300	460	2,924	783	450	450	450
80%	373	300	300	300	300	300	460	2,924	783	450	450	450
90%	373	300	300	300	300	300	427	1,498	783	450	450	450
Long Term												
Full Simulation Period ^b	368	359	610	697	671	642	559	3,753	2,210	890	450	445
Water Year Types^c												
Wet (32%)	373	510	1,277	1,552	1,215	1,297	643	4,556	3,413	1,136	450	450
Above Normal (16%)	373	300	300	300	691	462	457	4,597	2,948	1,102	450	450
Below Normal (13%)	373	300	300	300	438	303	517	3,585	1,755	924	450	450
Dry (24%)	354	300	300	300	300	300	528	3,250	1,271	678	450	450
Critical (15%)	373	250	300	300	300	300	575	2,092	783	450	450	413

Alternative 5												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	373	300	300	553	1,747	328	600	4,709	4,626	1,102	450	450
20%	373	300	300	300	300	300	540	4,709	2,526	1,102	450	450
30%	373	300	300	300	300	300	540	4,570	2,526	1,102	450	450
40%	373	300	300	300	300	300	521	4,570	2,526	1,102	450	450
50%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
60%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
70%	373	300	300	300	300	300	460	2,924	783	450	450	450
80%	373	300	300	300	300	300	460	2,924	783	450	450	450
90%	373	300	300	300	300	300	427	1,498	783	450	450	450
Long Term												
Full Simulation Period ^b	368	359	597	704	679	647	559	3,753	2,210	890	450	445
Water Year Types^c												
Wet (32%)	373	510	1,237	1,575	1,217	1,311	643	4,556	3,413	1,136	450	450
Above Normal (16%)	373	300	300	300	694	462	457	4,597	2,948	1,102	450	450
Below Normal (13%)	373	300	300	300	495	303	517	3,585	1,755	924	450	450
Dry (24%)	354	300	300	300	300	300	528	3,250	1,271	678	450	450
Critical (15%)	373	250	300	300	300	300	575	2,092	783	450	450	413

Alternative 5 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	1	506	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	-13	7	9	5	0	0	0	0	0	0
Water Year Types^c												
Wet (32%)	0	0	-40	23	2	14	0	0	0	0	0	0
Above Normal (16%)	0	0	0	0	3	0	0	0	0	0	0	0
Below Normal (13%)	0	0	0	0	56	0	0	0	0	0	0	0
Dry (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (15%)	0	0	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-21-4. Trinity River below Lewiston Reservoir, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	373	300	300	1,448	2,106	527	600	4,709	4,626	1,102	450	450
20%	373	300	300	300	300	300	540	4,709	2,526	1,102	450	450
30%	373	300	300	300	300	300	540	4,570	2,526	1,102	450	450
40%	373	300	300	300	300	300	521	4,570	2,526	1,102	450	450
50%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
60%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
70%	373	300	300	300	300	300	460	2,924	783	450	450	450
80%	373	300	300	300	300	300	460	2,924	783	450	450	450
90%	373	300	300	300	300	300	427	1,498	783	450	450	450
Long Term												
Full Simulation Period ^b	367	358	660	739	741	670	557	3,753	2,210	890	450	445
Water Year Types^c												
Wet (32%)	373	504	1,437	1,646	1,300	1,386	639	4,556	3,413	1,136	450	450
Above Normal (16%)	373	300	300	374	801	462	457	4,597	2,948	1,102	450	450
Below Normal (13%)	373	300	300	300	630	303	517	3,585	1,755	924	450	450
Dry (24%)	354	300	300	300	300	300	528	3,250	1,271	678	450	450
Critical (15%)	364	257	300	300	300	300	575	2,092	783	450	450	413

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	373	300	300	552	1,240	328	600	4,709	4,626	1,102	450	450
20%	373	300	300	300	300	300	540	4,709	2,526	1,102	450	450
30%	373	300	300	300	300	300	540	4,570	2,526	1,102	450	450
40%	373	300	300	300	300	300	521	4,570	2,526	1,102	450	450
50%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
60%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
70%	373	300	300	300	300	300	460	2,924	783	450	450	450
80%	373	300	300	300	300	300	460	2,924	783	450	450	450
90%	373	300	300	300	300	300	427	1,498	783	450	450	450
Long Term												
Full Simulation Period ^b	368	359	610	697	671	642	559	3,753	2,210	890	450	445
Water Year Types^c												
Wet (32%)	373	510	1,277	1,552	1,215	1,297	643	4,556	3,413	1,136	450	450
Above Normal (16%)	373	300	300	300	691	462	457	4,597	2,948	1,102	450	450
Below Normal (13%)	373	300	300	300	438	303	517	3,585	1,755	924	450	450
Dry (24%)	354	300	300	300	300	300	528	3,250	1,271	678	450	450
Critical (15%)	373	250	300	300	300	300	575	2,092	783	450	450	413

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	-896	-866	-198	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	1	1	-51	-42	-70	-28	1	0	0	0	0	0
Water Year Types^c												
Wet (32%)	0	6	-160	-94	-86	-89	4	0	0	0	0	0
Above Normal (16%)	0	0	0	-74	-110	0	0	0	0	0	0	0
Below Normal (13%)	0	0	0	0	-192	0	0	0	0	0	0	0
Dry (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (15%)	9	-7	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-21-5. Trinity River below Lewiston Reservoir, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	373	300	300	1,448	2,106	527	600	4,709	4,626	1,102	450	450
20%	373	300	300	300	300	300	540	4,709	2,526	1,102	450	450
30%	373	300	300	300	300	300	540	4,570	2,526	1,102	450	450
40%	373	300	300	300	300	300	521	4,570	2,526	1,102	450	450
50%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
60%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
70%	373	300	300	300	300	300	460	2,924	783	450	450	450
80%	373	300	300	300	300	300	460	2,924	783	450	450	450
90%	373	300	300	300	300	300	427	1,498	783	450	450	450
Long Term												
Full Simulation Period ^b	367	358	660	739	741	670	557	3,753	2,210	890	450	445
Water Year Types ^c												
Wet (32%)	373	504	1,437	1,646	1,300	1,386	639	4,556	3,413	1,136	450	450
Above Normal (16%)	373	300	300	374	801	462	457	4,597	2,948	1,102	450	450
Below Normal (13%)	373	300	300	300	630	303	517	3,585	1,755	924	450	450
Dry (24%)	354	300	300	300	300	300	528	3,250	1,271	678	450	450
Critical (15%)	364	257	300	300	300	300	575	2,092	783	450	450	413

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	373	300	300	1,439	2,157	328	600	4,709	4,626	1,102	450	450
20%	373	300	300	300	300	300	540	4,709	2,526	1,102	450	450
30%	373	300	300	300	300	300	540	4,570	2,526	1,102	450	450
40%	373	300	300	300	300	300	493	4,570	2,526	1,102	450	450
50%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
60%	373	300	300	300	300	300	473	4,189	2,120	1,102	450	450
70%	373	300	300	300	300	300	460	2,924	783	450	450	450
80%	373	300	300	300	300	300	460	2,924	783	450	450	450
90%	373	300	300	300	300	300	427	1,498	783	450	450	450
Long Term												
Full Simulation Period ^b	368	355	671	737	750	667	551	3,753	2,210	890	450	445
Water Year Types ^c												
Wet (32%)	373	474	1,469	1,645	1,329	1,376	618	4,556	3,413	1,136	450	450
Above Normal (16%)	373	300	300	367	801	462	457	4,597	2,948	1,102	450	450
Below Normal (13%)	373	300	300	300	630	303	517	3,585	1,755	924	450	450
Dry (24%)	354	300	300	300	300	300	528	3,250	1,271	678	450	450
Critical (15%)	373	300	300	300	300	300	575	2,092	783	450	450	413

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0	0	0	-9	51	-198	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	-28	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	-20	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	1	-3	10	-2	9	-3	-7	0	0	0	0	0
Water Year Types ^c												
Wet (32%)	0	-30	32	-2	29	-10	-22	0	0	0	0	0
Above Normal (16%)	0	0	0	-7	0	0	0	0	0	0	0	0
Below Normal (13%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (15%)	9	43	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-21-6. Trinity River below Lewiston Reservoir, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	373	300	300	1,448	2,106	527	600	4,709	4,626	1,102	450	450
20%	373	300	300	300	300	300	540	4,709	2,526	1,102	450	450
30%	373	300	300	300	300	300	540	4,570	2,526	1,102	450	450
40%	373	300	300	300	300	300	521	4,570	2,526	1,102	450	450
50%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
60%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
70%	373	300	300	300	300	300	460	2,924	783	450	450	450
80%	373	300	300	300	300	300	460	2,924	783	450	450	450
90%	373	300	300	300	300	300	427	1,498	783	450	450	450
Long Term												
Full Simulation Period ^b	367	358	660	739	741	670	557	3,753	2,210	890	450	445
Water Year Types ^c												
Wet (32%)	373	504	1,437	1,646	1,300	1,386	639	4,556	3,413	1,136	450	450
Above Normal (16%)	373	300	300	374	801	462	457	4,597	2,948	1,102	450	450
Below Normal (13%)	373	300	300	300	630	303	517	3,585	1,755	924	450	450
Dry (24%)	354	300	300	300	300	300	528	3,250	1,271	678	450	450
Critical (15%)	364	257	300	300	300	300	575	2,092	783	450	450	413

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	373	300	300	553	1,747	328	600	4,709	4,626	1,102	450	450
20%	373	300	300	300	300	300	540	4,709	2,526	1,102	450	450
30%	373	300	300	300	300	300	540	4,570	2,526	1,102	450	450
40%	373	300	300	300	300	300	521	4,570	2,526	1,102	450	450
50%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
60%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
70%	373	300	300	300	300	300	460	2,924	783	450	450	450
80%	373	300	300	300	300	300	460	2,924	783	450	450	450
90%	373	300	300	300	300	300	427	1,498	783	450	450	450
Long Term												
Full Simulation Period ^b	368	359	597	704	679	647	559	3,753	2,210	890	450	445
Water Year Types ^c												
Wet (32%)	373	510	1,237	1,575	1,217	1,311	643	4,556	3,413	1,136	450	450
Above Normal (16%)	373	300	300	300	694	462	457	4,597	2,948	1,102	450	450
Below Normal (13%)	373	300	300	300	495	303	517	3,585	1,755	924	450	450
Dry (24%)	354	300	300	300	300	300	528	3,250	1,271	678	450	450
Critical (15%)	373	250	300	300	300	300	575	2,092	783	450	450	413

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0	0	0	-895	-359	-198	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	1	1	-63	-34	-62	-24	1	0	0	0	0	0
Water Year Types ^c												
Wet (32%)	0	6	-200	-71	-84	-75	4	0	0	0	0	0
Above Normal (16%)	0	0	0	-74	-107	0	0	0	0	0	0	0
Below Normal (13%)	0	0	0	0	-135	0	0	0	0	0	0	0
Dry (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (15%)	9	-7	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1 **C.22. Clear Creek Flow below Whiskeytown**


Figure C-22-1. Clear Creek below Whiskeytown, Long-Term* Average Flow

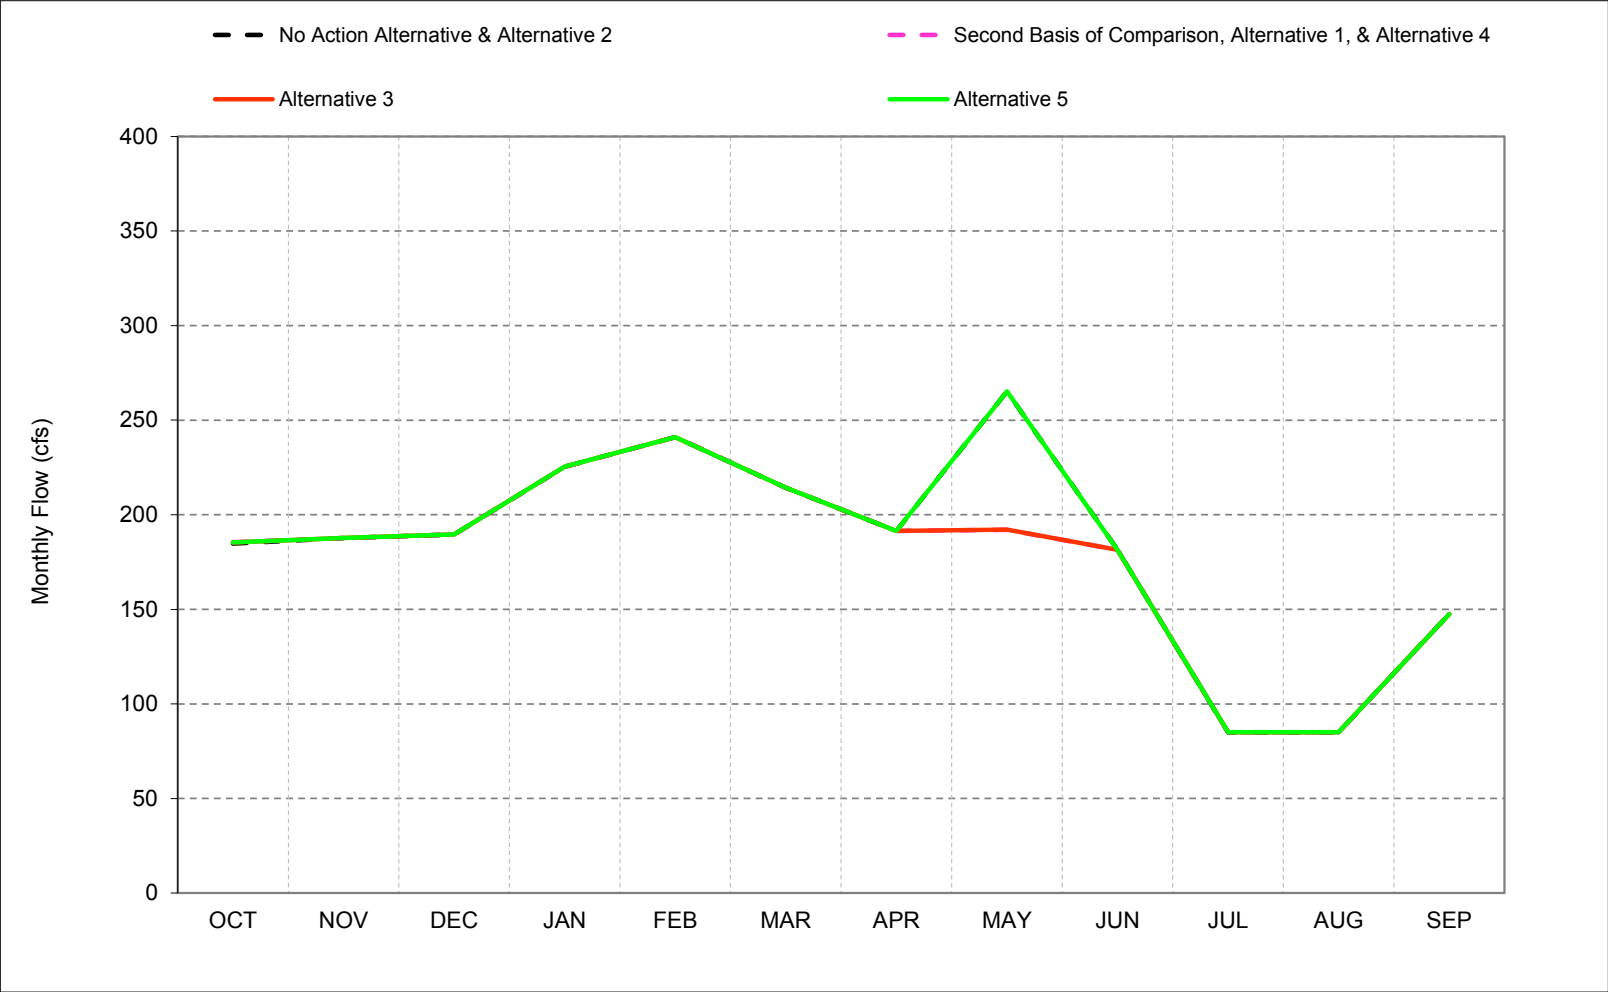

*Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-22-2. Clear Creek below Whiskeytown, Wet Year* Long-Term** Average Flow

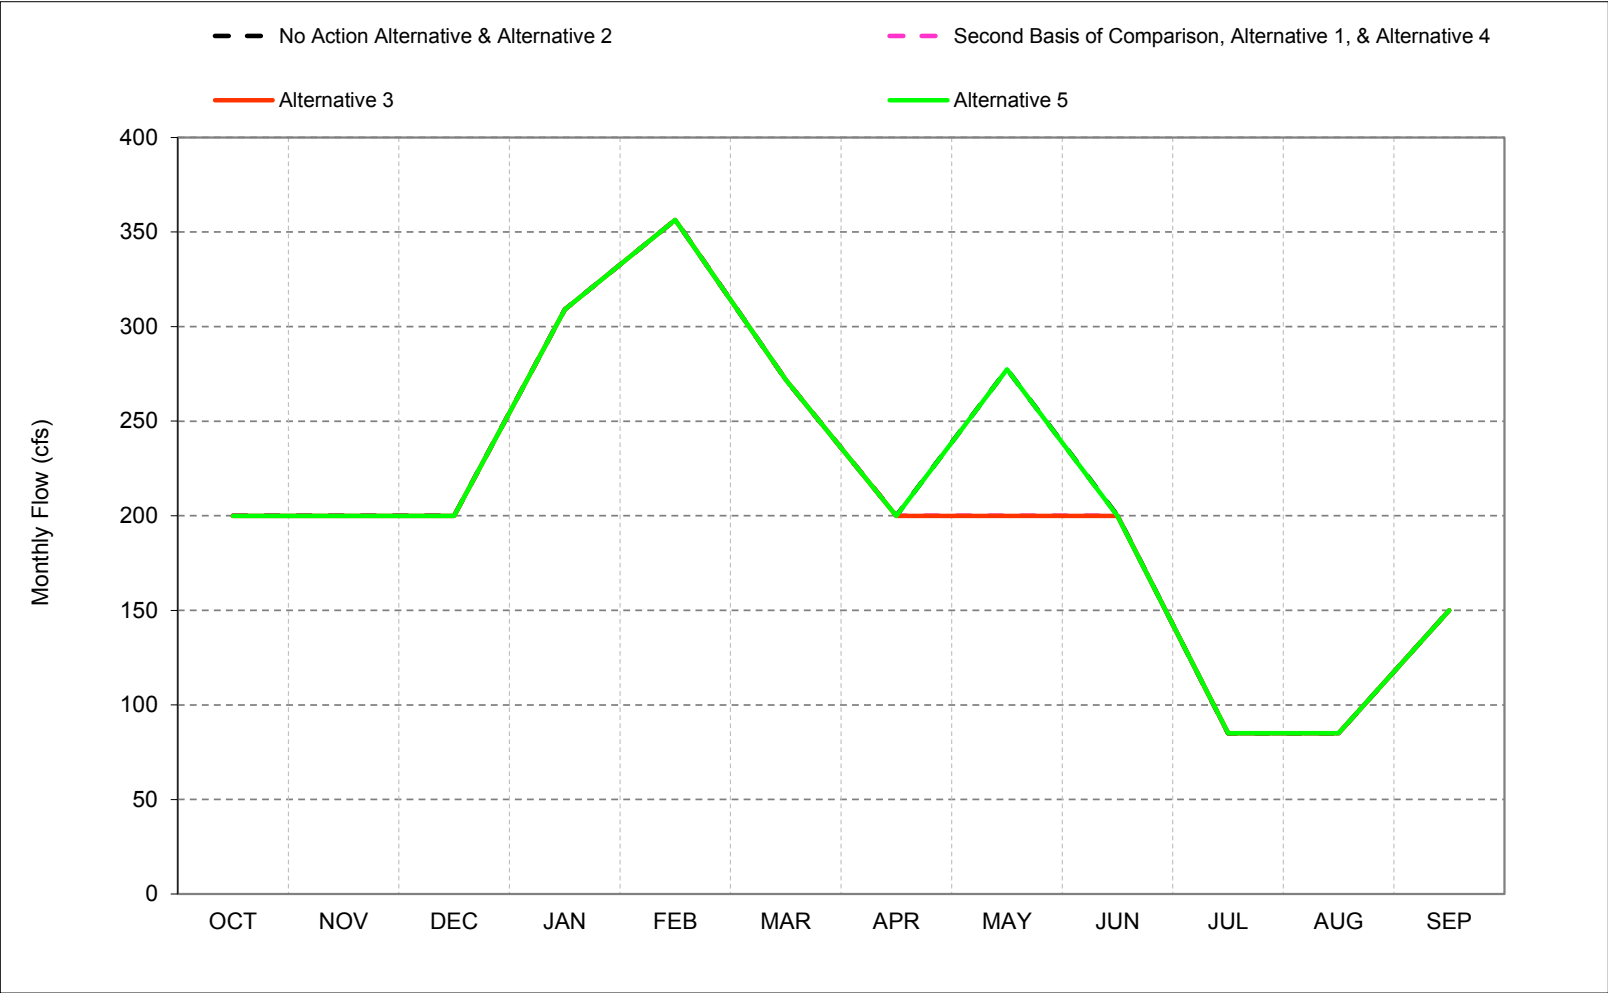


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-22-3. Clear Creek below Whiskeytown, Above Normal Year* Long-Term** Average Flow

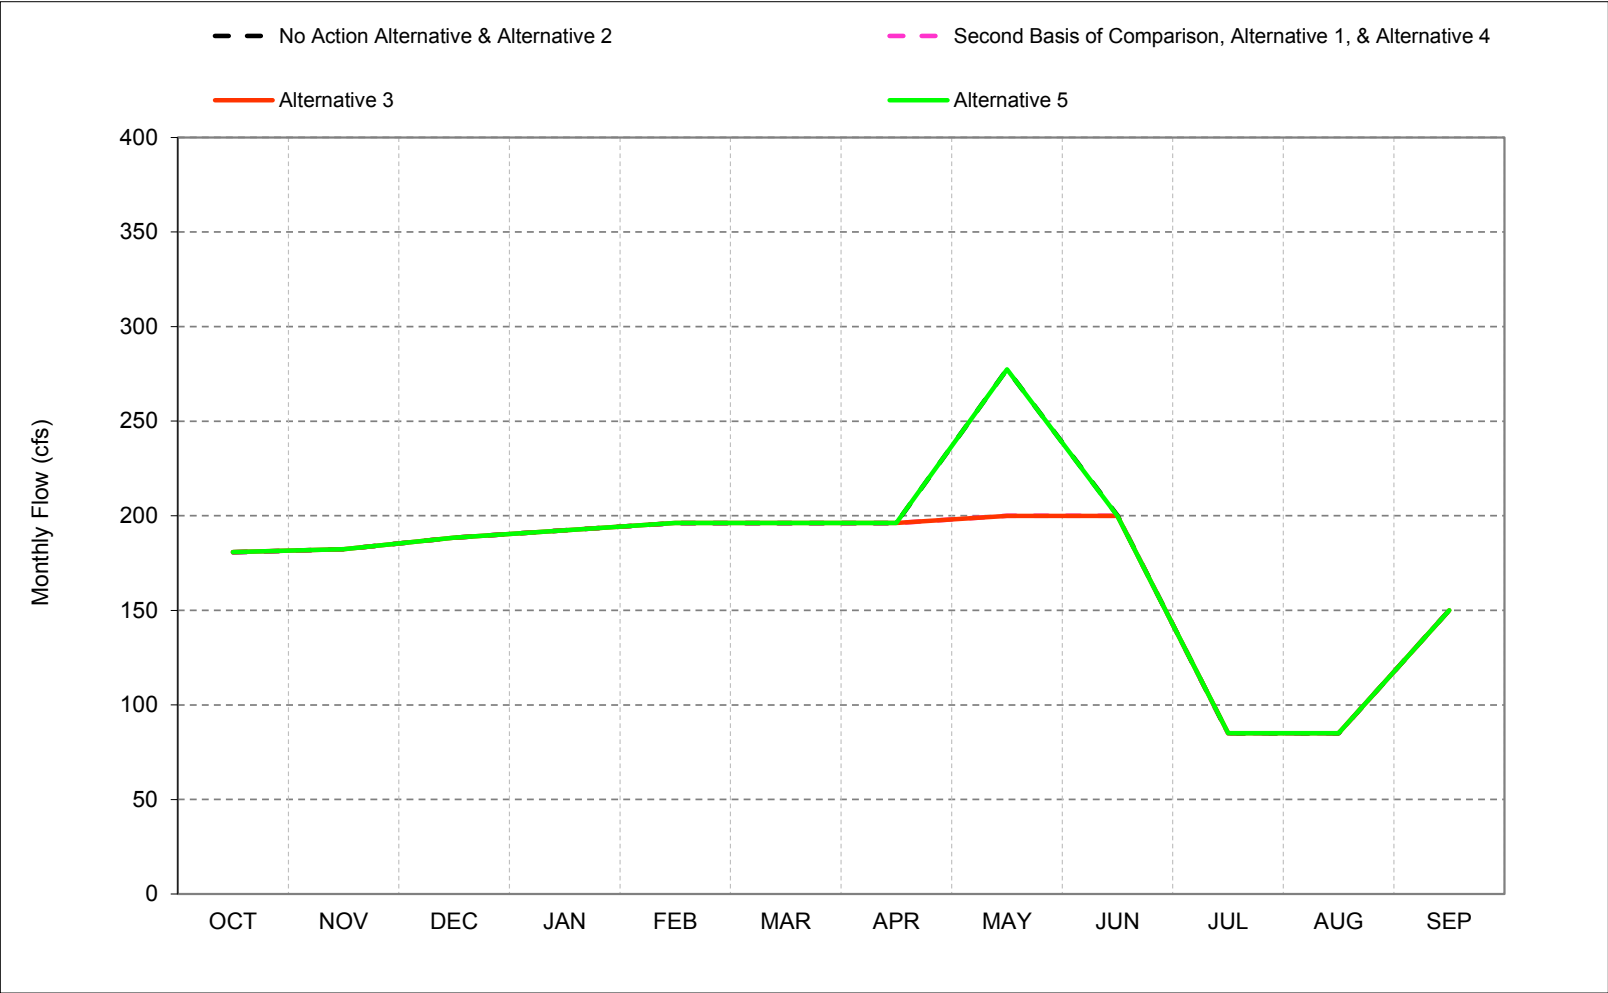


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-22-4. Clear Creek below Whiskeytown, Below Normal Year* Long-Term** Average Flow

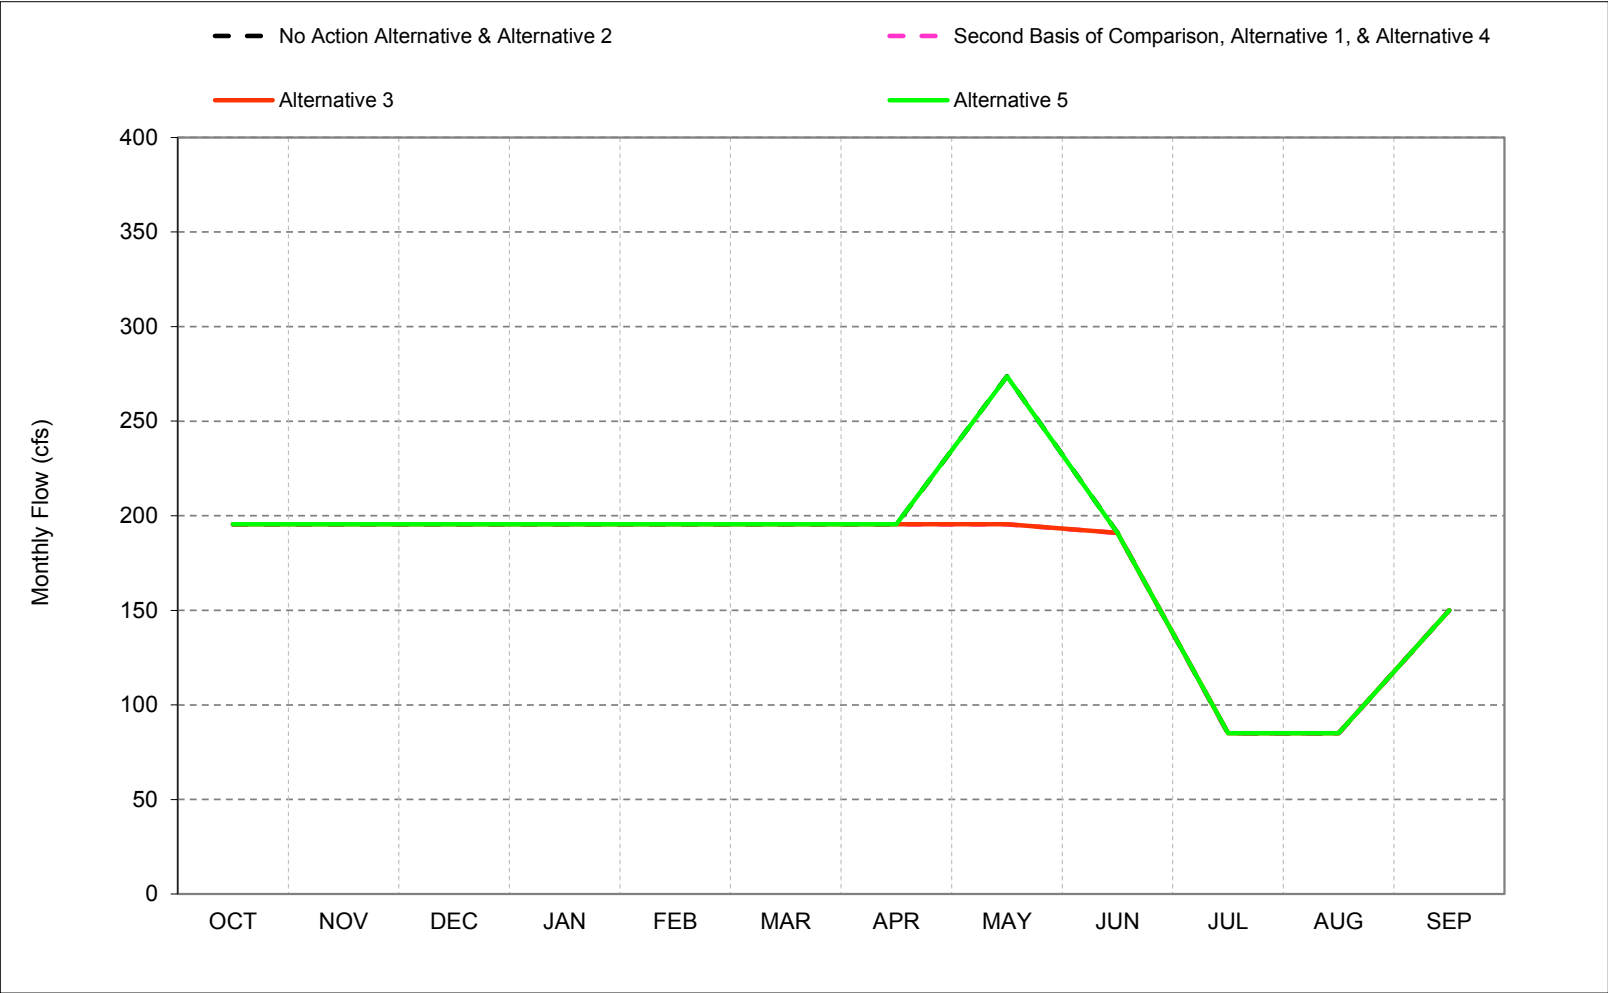


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-22-5. Clear Creek below Whiskeytown, Dry Year* Long-Term** Average Flow

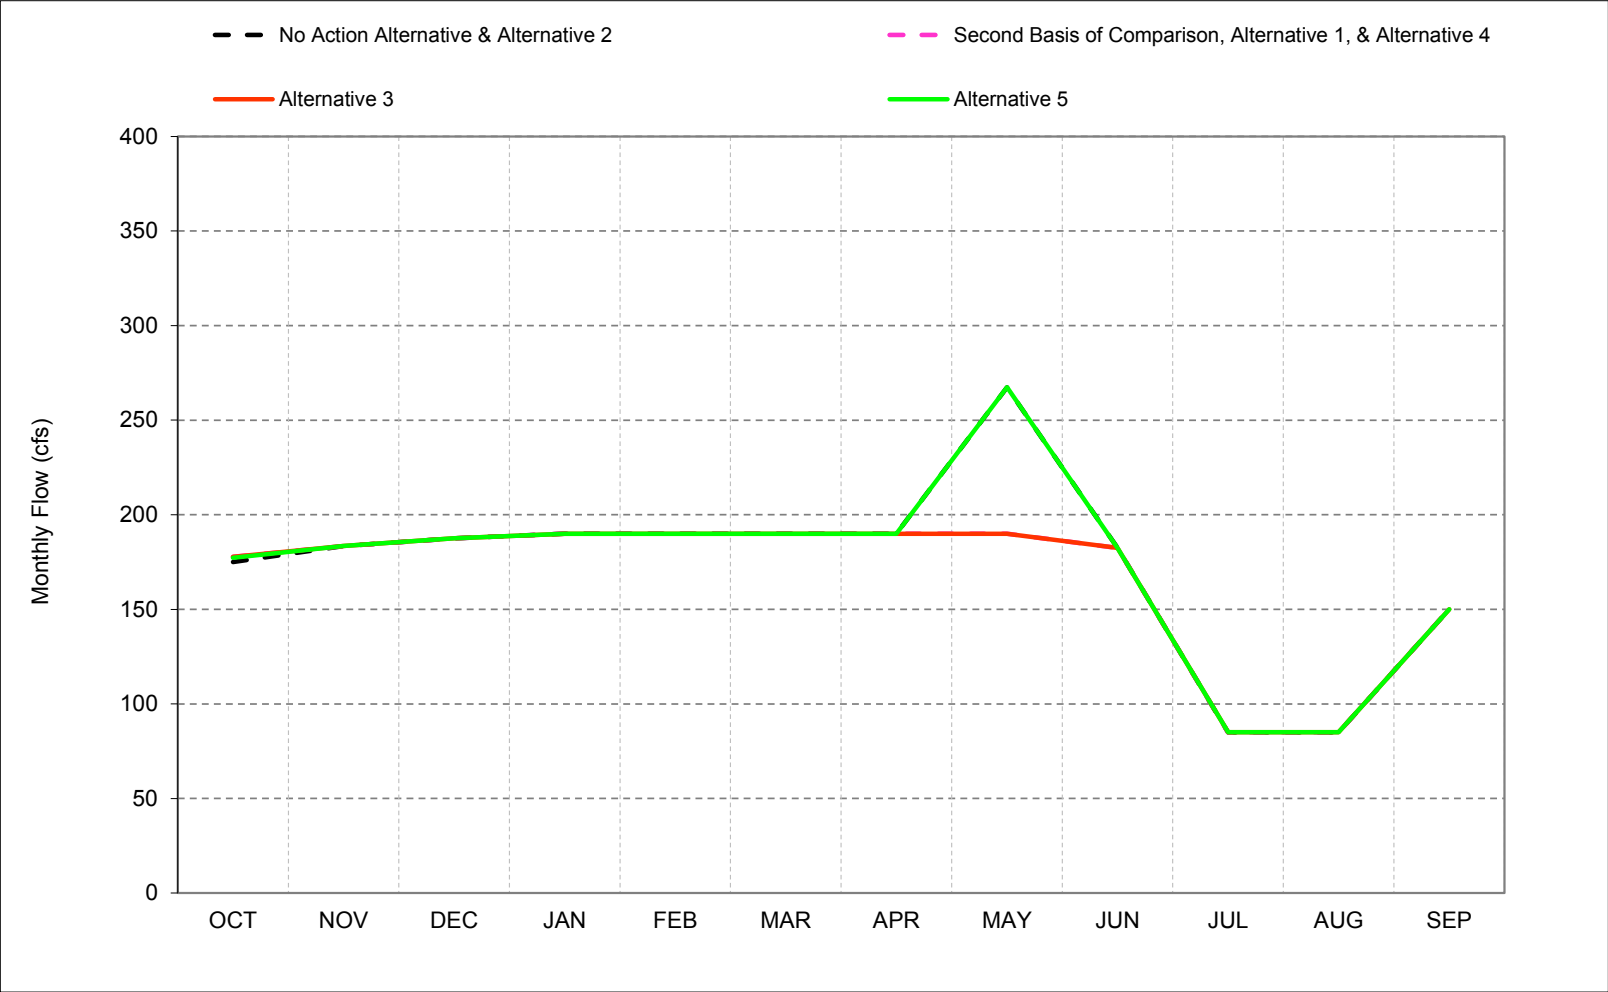


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-22-6. Clear Creek below Whiskeytown, Critical Year* Long-Term** Average Flow

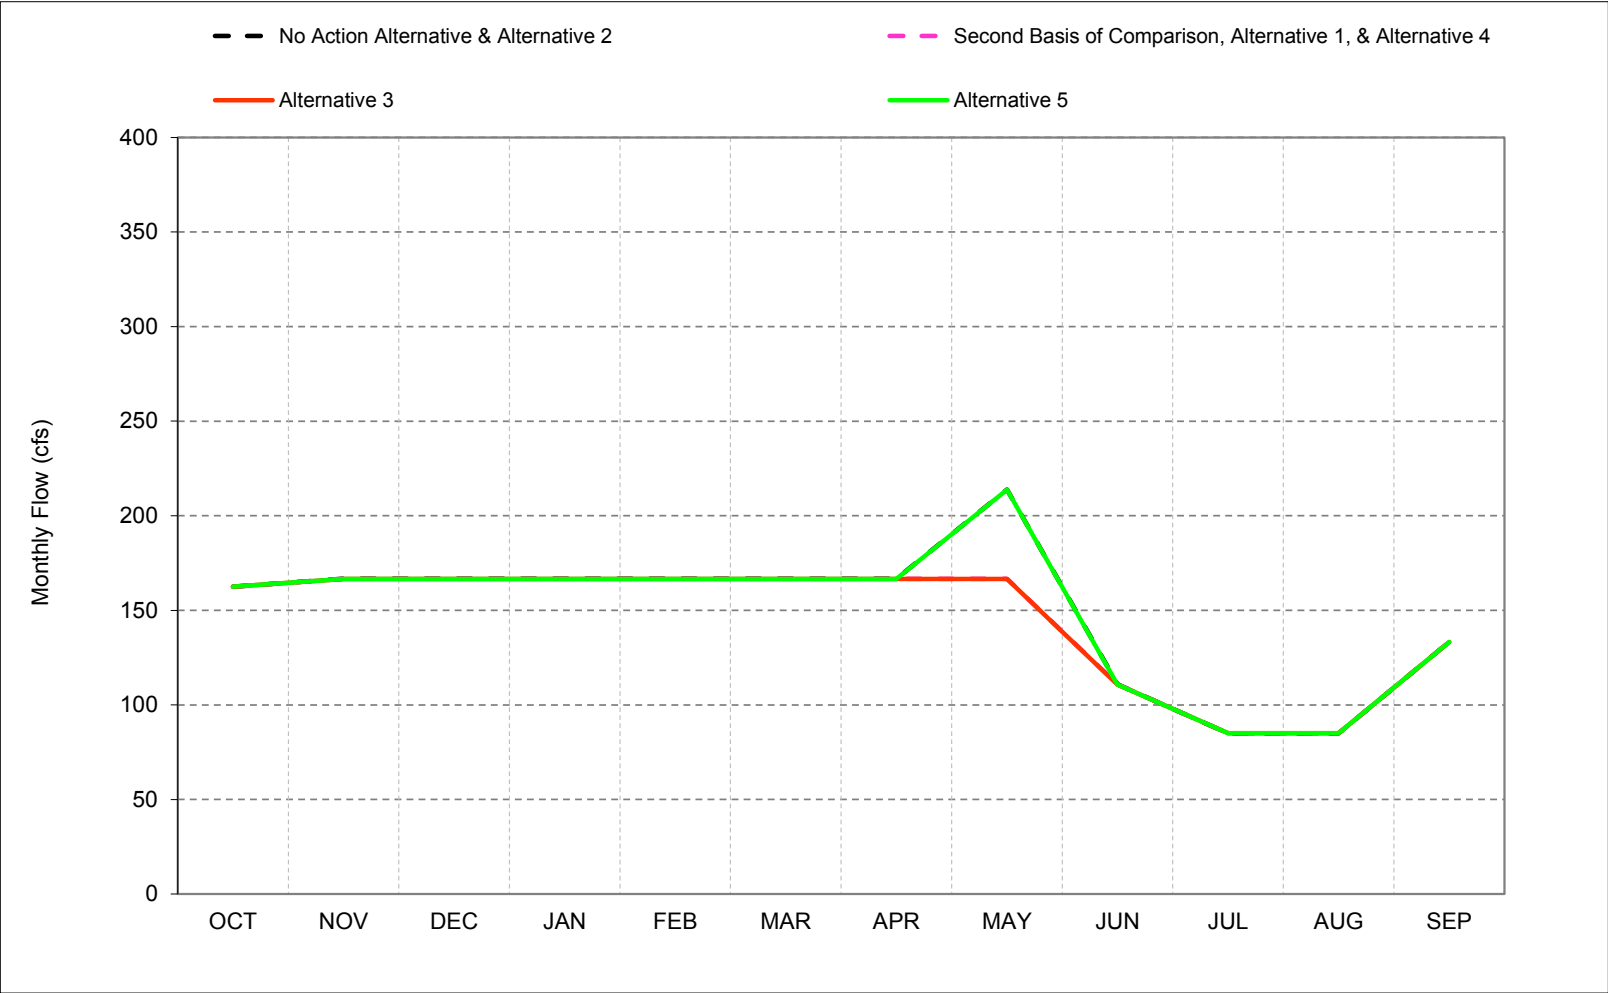

*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-22-1. Clear Creek below Whiskeytown, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	200	200	200	200	200	200	200	277	200	85	85	150
20%	200	200	200	200	200	200	200	277	200	85	85	150
30%	200	200	200	200	200	200	200	277	200	85	85	150
40%	200	200	200	200	200	200	200	277	200	85	85	150
50%	200	200	200	200	200	200	200	277	200	85	85	150
60%	200	200	200	200	200	200	200	277	200	85	85	150
70%	200	200	200	200	200	200	200	277	200	85	85	150
80%	200	200	200	200	200	200	200	277	150	85	85	150
90%	150	150	150	150	150	150	150	237	150	85	85	150
Long Term												
Full Simulation Period ^b	185	188	190	225	241	214	191	265	181	85	85	148
Water Year Types^c												
Wet (32%)	200	200	200	309	356	272	200	277	200	85	85	150
Above Normal (16%)	181	182	188	192	196	196	196	277	200	85	85	150
Below Normal (13%)	195	195	195	195	195	195	195	274	191	85	85	150
Dry (24%)	175	184	188	190	190	190	190	267	183	85	85	150
Critical (15%)	163	167	167	167	167	167	167	214	111	85	85	133

Alternative 1												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	200	200	200	200	200	200	200	200	200	85	85	150
20%	200	200	200	200	200	200	200	200	200	85	85	150
30%	200	200	200	200	200	200	200	200	200	85	85	150
40%	200	200	200	200	200	200	200	200	200	85	85	150
50%	200	200	200	200	200	200	200	200	200	85	85	150
60%	200	200	200	200	200	200	200	200	200	85	85	150
70%	200	200	200	200	200	200	200	200	200	85	85	150
80%	200	200	200	200	200	200	200	200	150	85	85	150
90%	150	150	150	150	150	150	150	150	150	85	85	150
Long Term												
Full Simulation Period ^b	185	188	190	225	241	214	191	192	181	85	85	148
Water Year Types^c												
Wet (32%)	200	200	200	309	356	272	200	200	200	85	85	150
Above Normal (16%)	181	182	188	192	196	196	196	200	200	85	85	150
Below Normal (13%)	195	195	195	195	195	195	195	195	191	85	85	150
Dry (24%)	178	184	188	190	190	190	190	190	183	85	85	150
Critical (15%)	163	167	167	167	167	167	167	167	111	85	85	133

Alternative 1 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	0	0	0	-77	0	0	0	0
20%	0	0	0	0	0	0	0	-77	0	0	0	0
30%	0	0	0	0	0	0	0	-77	0	0	0	0
40%	0	0	0	0	0	0	0	-77	0	0	0	0
50%	0	0	0	0	0	0	0	-77	0	0	0	0
60%	0	0	0	0	0	0	0	-77	0	0	0	0
70%	0	0	0	0	0	0	0	-77	0	0	0	0
80%	0	0	0	0	0	0	0	-77	0	0	0	0
90%	0	0	0	0	0	0	0	-87	0	0	0	0
Long Term												
Full Simulation Period ^b	1	0	0	0	0	0	0	-73	0	0	0	0
Water Year Types^c												
Wet (32%)	0	0	0	0	0	0	0	-77	0	0	0	0
Above Normal (16%)	0	0	0	0	0	0	0	-77	0	0	0	0
Below Normal (13%)	0	0	0	0	0	0	0	-78	0	0	0	0
Dry (24%)	3	0	0	0	0	0	0	-77	0	0	0	0
Critical (15%)	0	0	0	0	0	0	0	-47	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-22-2. Clear Creek below Whiskeytown, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	200	200	200	200	200	200	200	277	200	85	85	150
20%	200	200	200	200	200	200	200	277	200	85	85	150
30%	200	200	200	200	200	200	200	277	200	85	85	150
40%	200	200	200	200	200	200	200	277	200	85	85	150
50%	200	200	200	200	200	200	200	277	200	85	85	150
60%	200	200	200	200	200	200	200	277	200	85	85	150
70%	200	200	200	200	200	200	200	277	200	85	85	150
80%	200	200	200	200	200	200	200	277	150	85	85	150
90%	150	150	150	150	150	150	150	237	150	85	85	150
Long Term												
Full Simulation Period ^b	185	188	190	225	241	214	191	265	181	85	85	148
Water Year Types^c												
Wet (32%)	200	200	200	309	356	272	200	277	200	85	85	150
Above Normal (16%)	181	182	188	192	196	196	196	277	200	85	85	150
Below Normal (13%)	195	195	195	195	195	195	195	274	191	85	85	150
Dry (24%)	175	184	188	190	190	190	190	267	183	85	85	150
Critical (15%)	163	167	167	167	167	167	167	214	111	85	85	133

Alternative 3												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	200	200	200	200	200	200	200	200	200	85	85	150
20%	200	200	200	200	200	200	200	200	200	85	85	150
30%	200	200	200	200	200	200	200	200	200	85	85	150
40%	200	200	200	200	200	200	200	200	200	85	85	150
50%	200	200	200	200	200	200	200	200	200	85	85	150
60%	200	200	200	200	200	200	200	200	200	85	85	150
70%	200	200	200	200	200	200	200	200	200	85	85	150
80%	200	200	200	200	200	200	200	200	150	85	85	150
90%	150	150	150	150	150	150	150	150	150	85	85	150
Long Term												
Full Simulation Period ^b	185	188	190	225	241	214	191	192	181	85	85	148
Water Year Types^c												
Wet (32%)	200	200	200	309	356	272	200	200	200	85	85	150
Above Normal (16%)	181	182	188	192	196	196	196	200	200	85	85	150
Below Normal (13%)	195	195	195	195	195	195	195	195	191	85	85	150
Dry (24%)	178	184	188	190	190	190	190	190	183	85	85	150
Critical (15%)	163	167	167	167	167	167	167	167	111	85	85	133

Alternative 3 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	0	0	0	-77	0	0	0	0
20%	0	0	0	0	0	0	0	-77	0	0	0	0
30%	0	0	0	0	0	0	0	-77	0	0	0	0
40%	0	0	0	0	0	0	0	-77	0	0	0	0
50%	0	0	0	0	0	0	0	-77	0	0	0	0
60%	0	0	0	0	0	0	0	-77	0	0	0	0
70%	0	0	0	0	0	0	0	-77	0	0	0	0
80%	0	0	0	0	0	0	0	-77	0	0	0	0
90%	0	0	0	0	0	0	0	-87	0	0	0	0
Long Term												
Full Simulation Period ^b	1	0	0	0	0	0	0	-73	0	0	0	0
Water Year Types^c												
Wet (32%)	0	0	0	0	0	0	0	-77	0	0	0	0
Above Normal (16%)	0	0	0	0	0	0	0	-77	0	0	0	0
Below Normal (13%)	0	0	0	0	0	0	0	-78	0	0	0	0
Dry (24%)	3	0	0	0	0	0	0	-77	0	0	0	0
Critical (15%)	0	0	0	0	0	0	0	-47	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-22-3. Clear Creek below Whiskeytown, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	200	200	200	200	200	200	200	277	200	85	85	150
20%	200	200	200	200	200	200	200	277	200	85	85	150
30%	200	200	200	200	200	200	200	277	200	85	85	150
40%	200	200	200	200	200	200	200	277	200	85	85	150
50%	200	200	200	200	200	200	200	277	200	85	85	150
60%	200	200	200	200	200	200	200	277	200	85	85	150
70%	200	200	200	200	200	200	200	277	200	85	85	150
80%	200	200	200	200	200	200	200	277	150	85	85	150
90%	150	150	150	150	150	150	150	237	150	85	85	150
Long Term												
Full Simulation Period ^b	185	188	190	225	241	214	191	265	181	85	85	148
Water Year Types^c												
Wet (32%)	200	200	200	309	356	272	200	277	200	85	85	150
Above Normal (16%)	181	182	188	192	196	196	196	277	200	85	85	150
Below Normal (13%)	195	195	195	195	195	195	195	274	191	85	85	150
Dry (24%)	175	184	188	190	190	190	190	267	183	85	85	150
Critical (15%)	163	167	167	167	167	167	167	214	111	85	85	133

Alternative 5												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	200	200	200	200	200	200	200	277	200	85	85	150
20%	200	200	200	200	200	200	200	277	200	85	85	150
30%	200	200	200	200	200	200	200	277	200	85	85	150
40%	200	200	200	200	200	200	200	277	200	85	85	150
50%	200	200	200	200	200	200	200	277	200	85	85	150
60%	200	200	200	200	200	200	200	277	200	85	85	150
70%	200	200	200	200	200	200	200	277	200	85	85	150
80%	200	200	200	200	200	200	200	277	150	85	85	150
90%	150	150	150	150	150	150	150	237	150	85	85	150
Long Term												
Full Simulation Period ^b	185	188	190	225	241	214	191	265	181	85	85	148
Water Year Types^c												
Wet (32%)	200	200	200	309	356	272	200	277	200	85	85	150
Above Normal (16%)	181	182	188	192	196	196	196	277	200	85	85	150
Below Normal (13%)	195	195	195	195	195	195	195	274	191	85	85	150
Dry (24%)	177	184	188	190	190	190	190	267	183	85	85	150
Critical (15%)	163	167	167	167	167	167	167	214	111	85	85	133

Alternative 5 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	1	0	0	0	0	0	0	0	0	0	0	0
Water Year Types^c												
Wet (32%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (13%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (24%)	2	0	0	0	0	0	0	0	0	0	0	0
Critical (15%)	0	0	0	0	0	0	0	0	0	0	0	0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-22-4. Clear Creek below Whiskeytown, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	200	200	200	200	200	200	200	200	200	85	85	150
20%	200	200	200	200	200	200	200	200	200	85	85	150
30%	200	200	200	200	200	200	200	200	200	85	85	150
40%	200	200	200	200	200	200	200	200	200	85	85	150
50%	200	200	200	200	200	200	200	200	200	85	85	150
60%	200	200	200	200	200	200	200	200	200	85	85	150
70%	200	200	200	200	200	200	200	200	200	85	85	150
80%	200	200	200	200	200	200	200	200	150	85	85	150
90%	150	150	150	150	150	150	150	150	150	85	85	150
Long Term												
Full Simulation Period ^b	185	188	190	225	241	214	191	192	181	85	85	148
Water Year Types^c												
Wet (32%)	200	200	200	309	356	272	200	200	200	85	85	150
Above Normal (16%)	181	182	188	192	196	196	196	200	200	85	85	150
Below Normal (13%)	195	195	195	195	195	195	195	195	191	85	85	150
Dry (24%)	178	184	188	190	190	190	190	190	183	85	85	150
Critical (15%)	163	167	167	167	167	167	167	167	111	85	85	133

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	200	200	200	200	200	200	200	277	200	85	85	150
20%	200	200	200	200	200	200	200	277	200	85	85	150
30%	200	200	200	200	200	200	200	277	200	85	85	150
40%	200	200	200	200	200	200	200	277	200	85	85	150
50%	200	200	200	200	200	200	200	277	200	85	85	150
60%	200	200	200	200	200	200	200	277	200	85	85	150
70%	200	200	200	200	200	200	200	277	200	85	85	150
80%	200	200	200	200	200	200	200	277	150	85	85	150
90%	150	150	150	150	150	150	150	237	150	85	85	150
Long Term												
Full Simulation Period ^b	185	188	190	225	241	214	191	265	181	85	85	148
Water Year Types^c												
Wet (32%)	200	200	200	309	356	272	200	277	200	85	85	150
Above Normal (16%)	181	182	188	192	196	196	196	277	200	85	85	150
Below Normal (13%)	195	195	195	195	195	195	195	274	191	85	85	150
Dry (24%)	175	184	188	190	190	190	190	267	183	85	85	150
Critical (15%)	163	167	167	167	167	167	167	214	111	85	85	133

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	0	0	0	77	0	0	0	0
20%	0	0	0	0	0	0	0	77	0	0	0	0
30%	0	0	0	0	0	0	0	77	0	0	0	0
40%	0	0	0	0	0	0	0	77	0	0	0	0
50%	0	0	0	0	0	0	0	77	0	0	0	0
60%	0	0	0	0	0	0	0	77	0	0	0	0
70%	0	0	0	0	0	0	0	77	0	0	0	0
80%	0	0	0	0	0	0	0	77	0	0	0	0
90%	0	0	0	0	0	0	0	87	0	0	0	0
Long Term												
Full Simulation Period ^b	-1	0	0	0	0	0	0	73	0	0	0	0
Water Year Types^c												
Wet (32%)	0	0	0	0	0	0	0	77	0	0	0	0
Above Normal (16%)	0	0	0	0	0	0	0	77	0	0	0	0
Below Normal (13%)	0	0	0	0	0	0	0	78	0	0	0	0
Dry (24%)	-3	0	0	0	0	0	0	77	0	0	0	0
Critical (15%)	0	0	0	0	0	0	0	47	0	0	0	0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-22-5. Clear Creek below Whiskeytown, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)												
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	200	200	200	200	200	200	200	200	200	200	85	85	150
20%	200	200	200	200	200	200	200	200	200	200	85	85	150
30%	200	200	200	200	200	200	200	200	200	200	85	85	150
40%	200	200	200	200	200	200	200	200	200	200	85	85	150
50%	200	200	200	200	200	200	200	200	200	200	85	85	150
60%	200	200	200	200	200	200	200	200	200	200	85	85	150
70%	200	200	200	200	200	200	200	200	200	200	85	85	150
80%	200	200	200	200	200	200	200	200	200	150	85	85	150
90%	150	150	150	150	150	150	150	150	150	150	85	85	150
Long Term													
Full Simulation Period ^b	185	188	190	225	241	214	191	192	181	85	85	148	
Water Year Types^c													
Wet (32%)	200	200	200	309	356	272	200	200	200	85	85	150	
Above Normal (16%)	181	182	188	192	196	196	196	200	200	85	85	150	
Below Normal (13%)	195	195	195	195	195	195	195	195	191	85	85	150	
Dry (24%)	178	184	188	190	190	190	190	190	183	85	85	150	
Critical (15%)	163	167	167	167	167	167	167	167	111	85	85	133	

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	200	200	200	200	200	200	200	200	200	85	85	150
20%	200	200	200	200	200	200	200	200	200	85	85	150
30%	200	200	200	200	200	200	200	200	200	85	85	150
40%	200	200	200	200	200	200	200	200	200	85	85	150
50%	200	200	200	200	200	200	200	200	200	85	85	150
60%	200	200	200	200	200	200	200	200	200	85	85	150
70%	200	200	200	200	200	200	200	200	200	85	85	150
80%	200	200	200	200	200	200	200	200	150	85	85	150
90%	150	150	150	150	150	150	150	150	150	85	85	150
Long Term												
Full Simulation Period ^b	185	188	190	225	241	214	191	192	181	85	85	148
Water Year Types^c												
Wet (32%)	200	200	200	309	356	272	200	200	200	85	85	150
Above Normal (16%)	181	182	188	192	196	196	196	200	200	85	85	150
Below Normal (13%)	195	195	195	195	195	195	195	195	191	85	85	150
Dry (24%)	178	184	188	190	190	190	190	190	183	85	85	150
Critical (15%)	163	167	167	167	167	167	167	167	111	85	85	133

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types^c												
Wet (32%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (13%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (15%)	0	0	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-22-6. Clear Creek below Whiskeytown, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	200	200	200	200	200	200	200	200	200	85	85	150
20%	200	200	200	200	200	200	200	200	200	85	85	150
30%	200	200	200	200	200	200	200	200	200	85	85	150
40%	200	200	200	200	200	200	200	200	200	85	85	150
50%	200	200	200	200	200	200	200	200	200	85	85	150
60%	200	200	200	200	200	200	200	200	200	85	85	150
70%	200	200	200	200	200	200	200	200	200	85	85	150
80%	200	200	200	200	200	200	200	200	150	85	85	150
90%	150	150	150	150	150	150	150	150	150	85	85	150
Long Term												
Full Simulation Period ^b	185	188	190	225	241	214	191	192	181	85	85	148
Water Year Types ^c												
Wet (32%)	200	200	200	309	356	272	200	200	200	85	85	150
Above Normal (16%)	181	182	188	192	196	196	196	200	200	85	85	150
Below Normal (13%)	195	195	195	195	195	195	195	195	191	85	85	150
Dry (24%)	178	184	188	190	190	190	190	190	183	85	85	150
Critical (15%)	163	167	167	167	167	167	167	167	111	85	85	133

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	200	200	200	200	200	200	200	277	200	85	85	150
20%	200	200	200	200	200	200	200	277	200	85	85	150
30%	200	200	200	200	200	200	200	277	200	85	85	150
40%	200	200	200	200	200	200	200	277	200	85	85	150
50%	200	200	200	200	200	200	200	277	200	85	85	150
60%	200	200	200	200	200	200	200	277	200	85	85	150
70%	200	200	200	200	200	200	200	277	200	85	85	150
80%	200	200	200	200	200	200	200	277	150	85	85	150
90%	150	150	150	150	150	150	150	237	150	85	85	150
Long Term												
Full Simulation Period ^b	185	188	190	225	241	214	191	265	181	85	85	148
Water Year Types ^c												
Wet (32%)	200	200	200	309	356	272	200	277	200	85	85	150
Above Normal (16%)	181	182	188	192	196	196	196	277	200	85	85	150
Below Normal (13%)	195	195	195	195	195	195	195	274	191	85	85	150
Dry (24%)	177	184	188	190	190	190	190	267	183	85	85	150
Critical (15%)	163	167	167	167	167	167	167	214	111	85	85	133

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0	0	0	0	0	0	0	77	0	0	0	0
20%	0	0	0	0	0	0	0	77	0	0	0	0
30%	0	0	0	0	0	0	0	77	0	0	0	0
40%	0	0	0	0	0	0	0	77	0	0	0	0
50%	0	0	0	0	0	0	0	77	0	0	0	0
60%	0	0	0	0	0	0	0	77	0	0	0	0
70%	0	0	0	0	0	0	0	77	0	0	0	0
80%	0	0	0	0	0	0	0	77	0	0	0	0
90%	0	0	0	0	0	0	0	87	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	73	0	0	0	0
Water Year Types ^c												
Wet (32%)	0	0	0	0	0	0	0	77	0	0	0	0
Above Normal (16%)	0	0	0	0	0	0	0	77	0	0	0	0
Below Normal (13%)	0	0	0	0	0	0	0	78	0	0	0	0
Dry (24%)	-1	0	0	0	0	0	0	77	0	0	0	0
Critical (15%)	0	0	0	0	0	0	0	47	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1 **C.23. Sacramento River Flow downstream of Keswick Reservoir**


Figure C-23-1. Sacramento River d/s of Keswick Reservoir, Long-Term* Average Flow

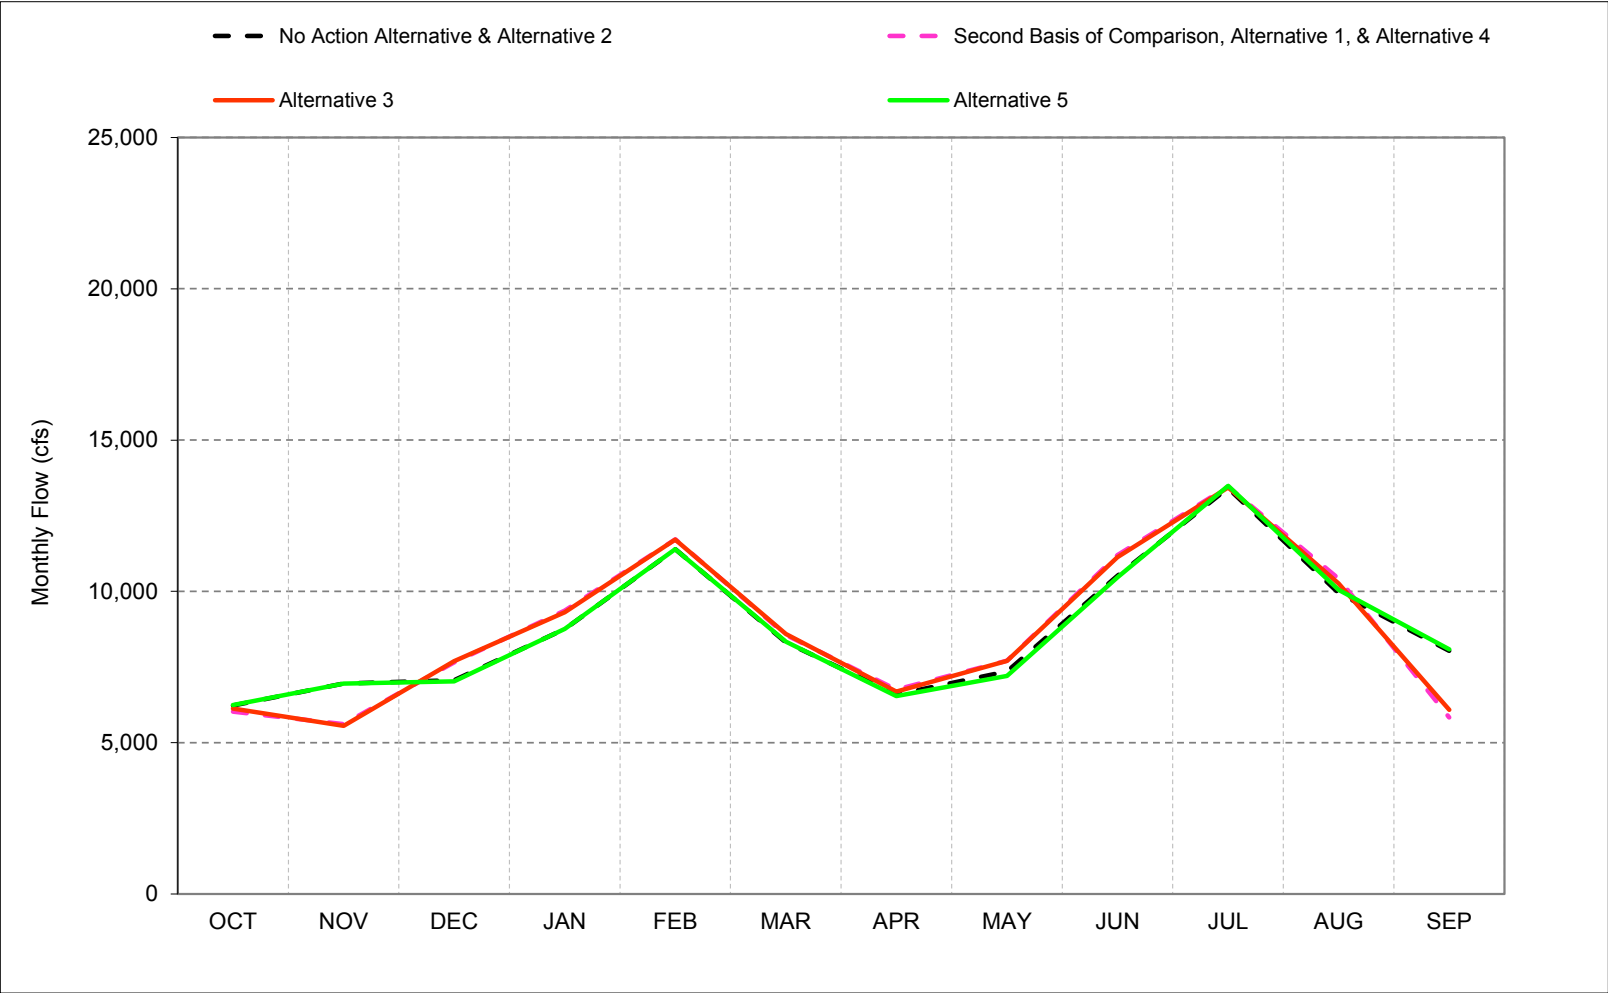

*Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-23-2. Sacramento River d/s of Keswick Reservoir, Wet Year* Long-Term** Average Flow

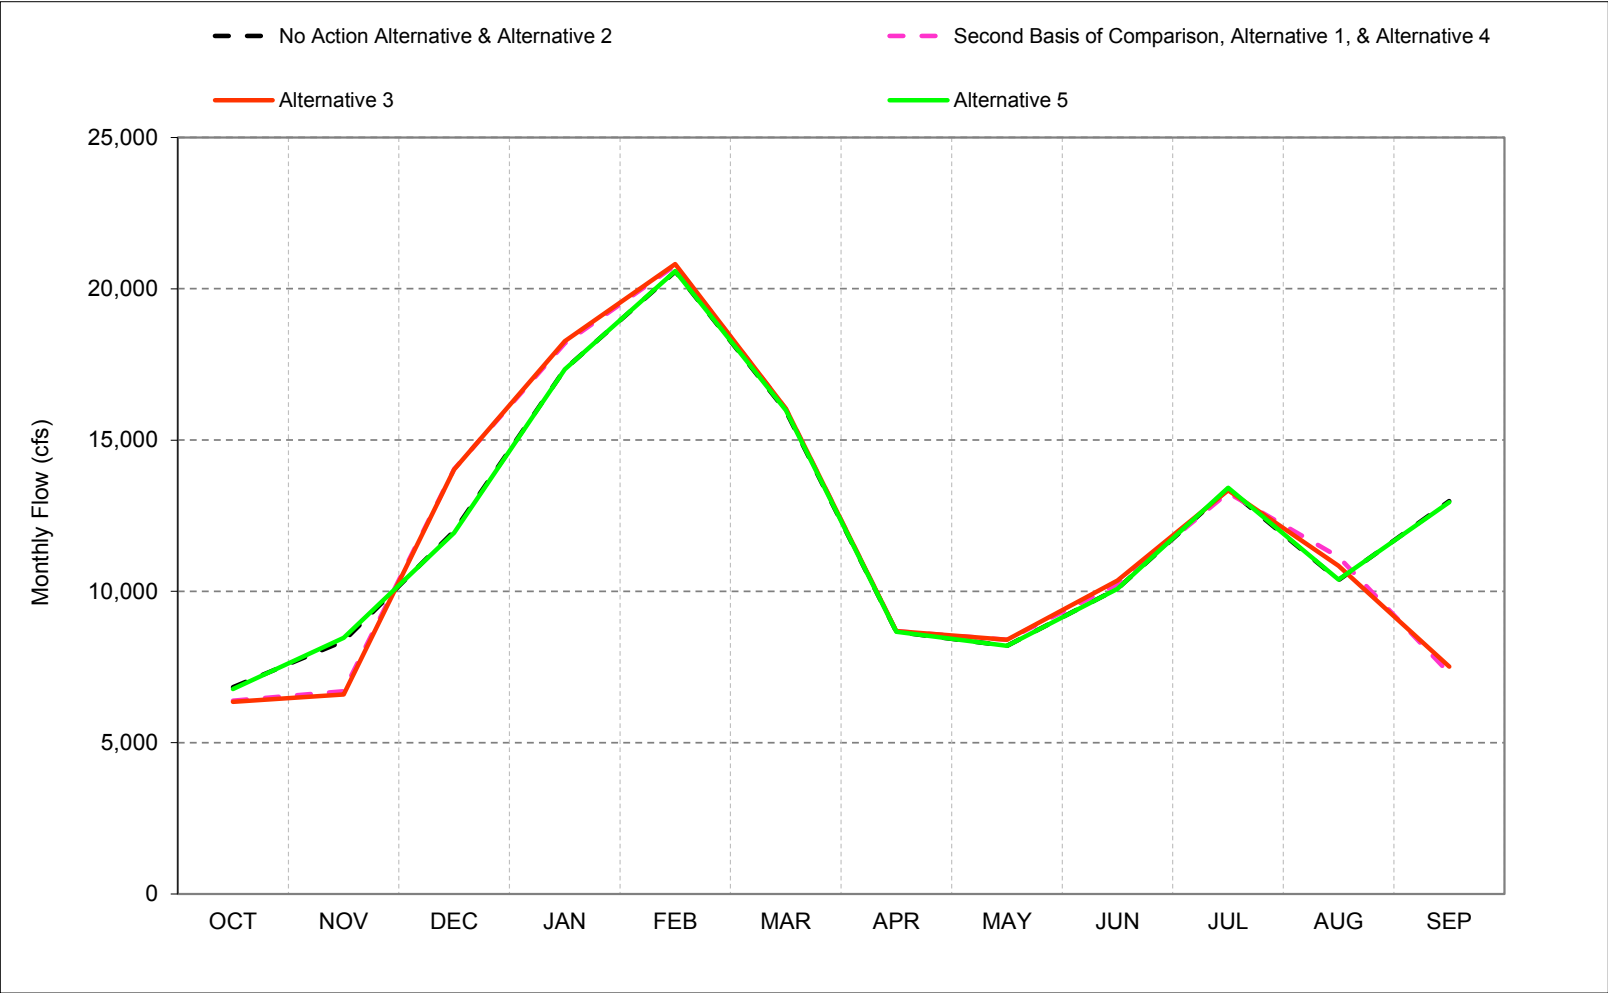


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-23-3. Sacramento River d/s of Keswick Reservoir, Above Normal Year* Long-Term** Average Flow

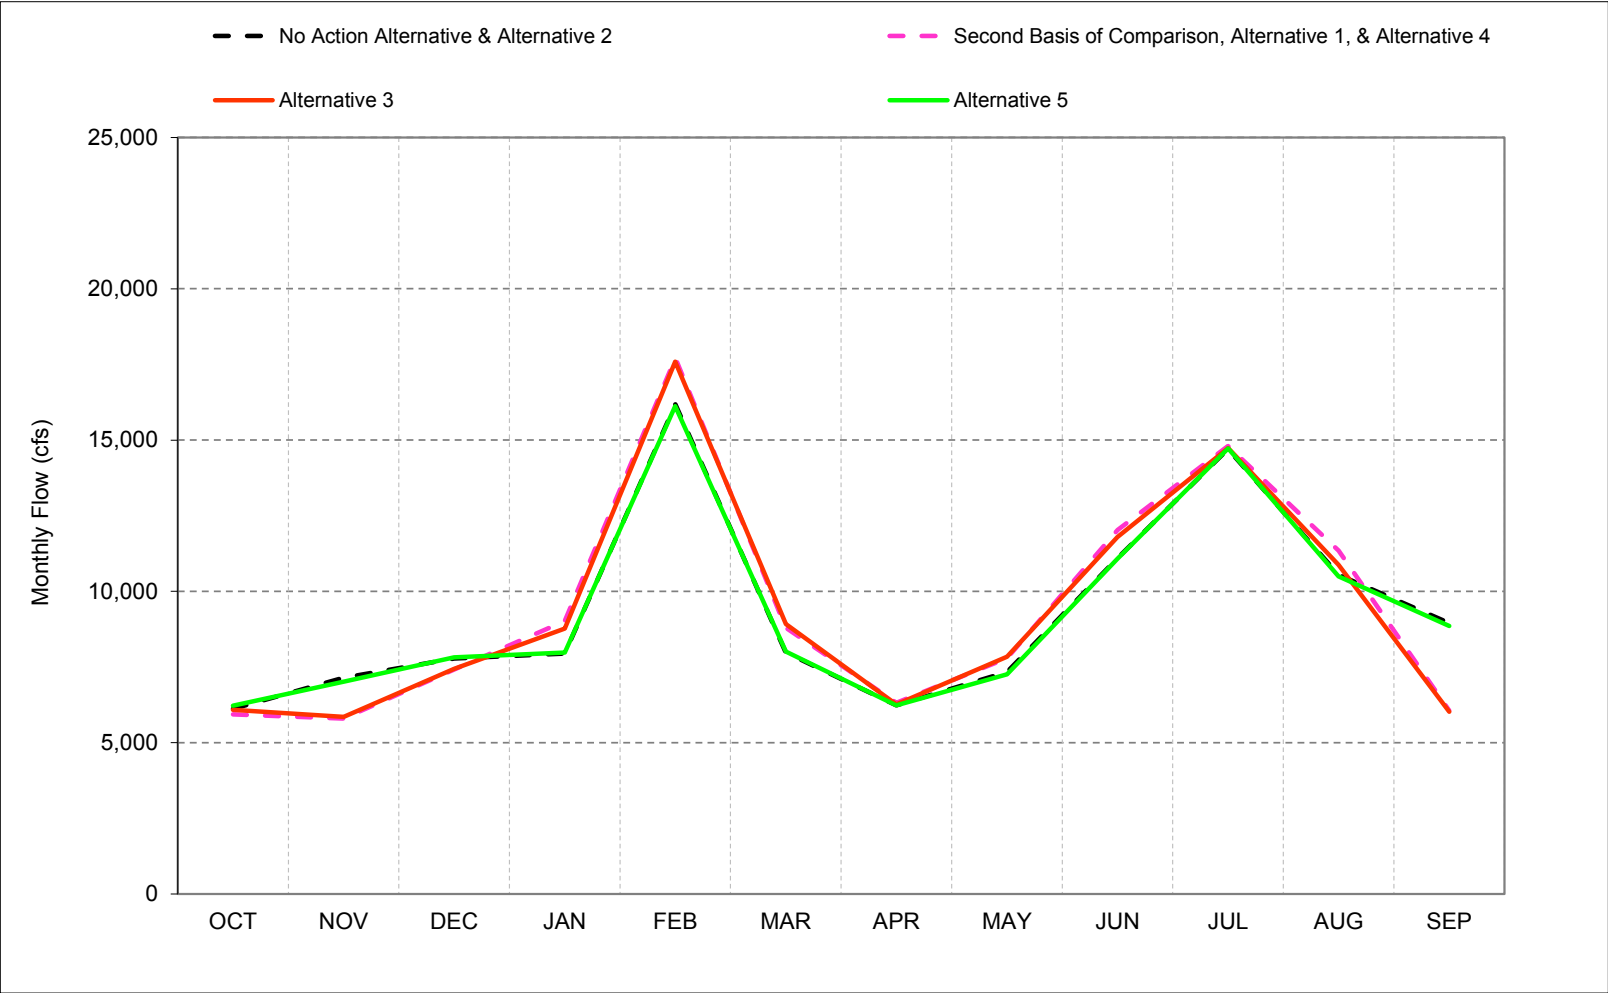


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-23-4. Sacramento River d/s of Keswick Reservoir, Below Normal Year* Long-Term** Average Flow

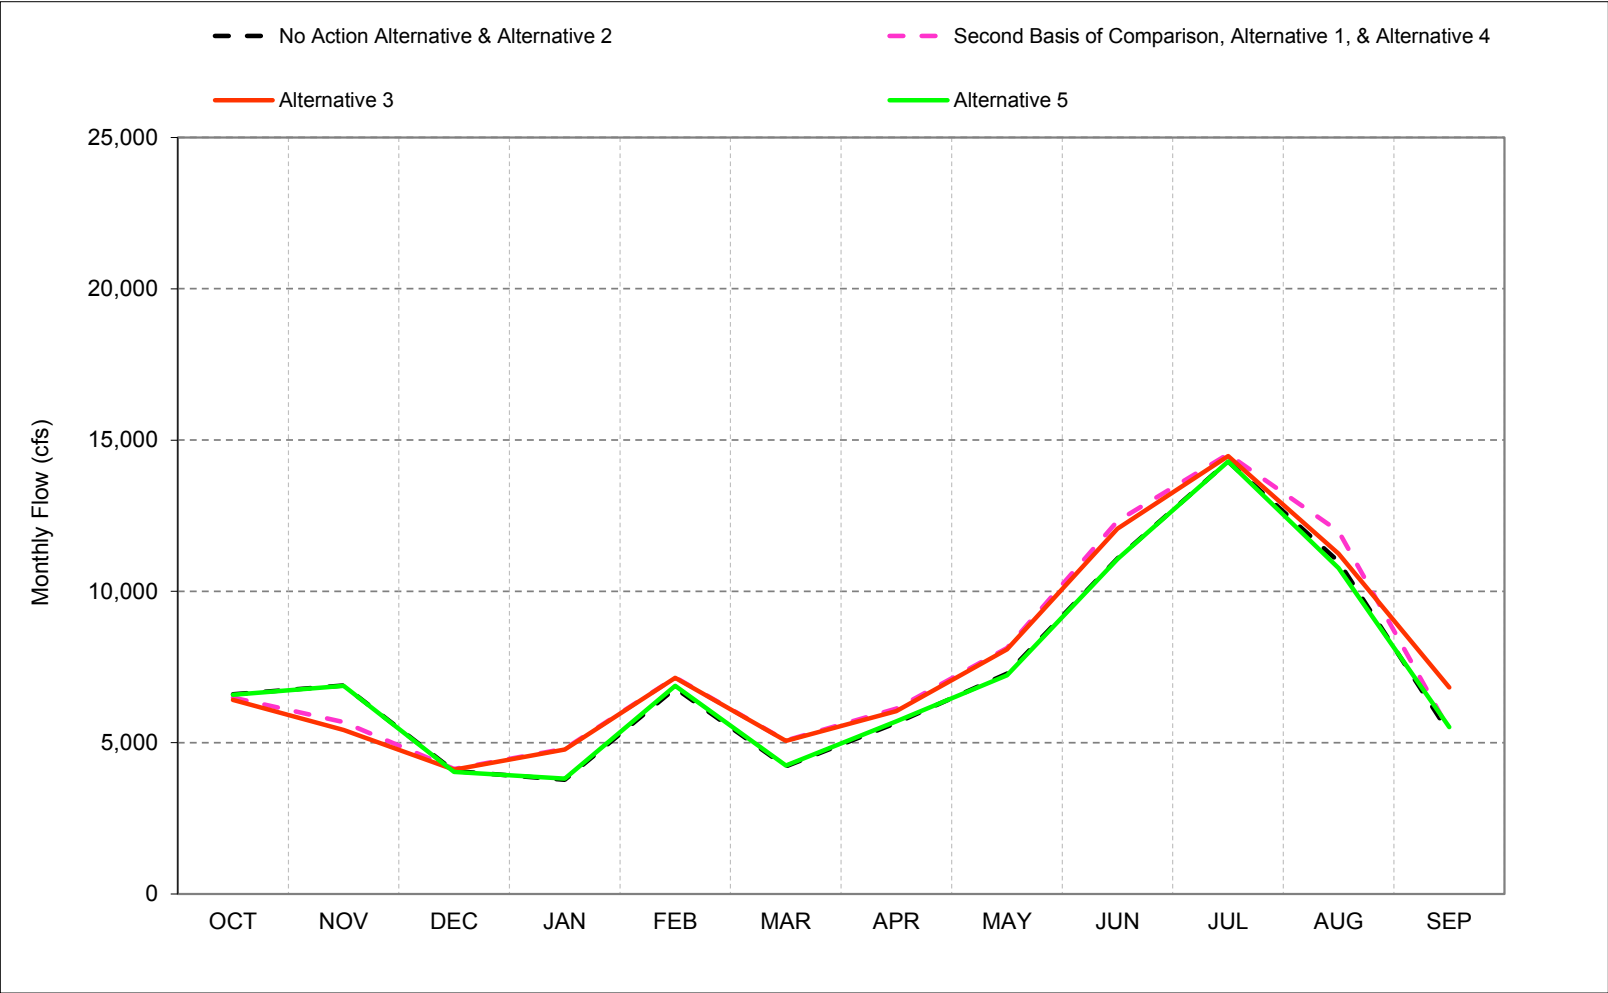


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-23-5. Sacramento River d/s of Keswick Reservoir, Dry Year* Long-Term** Average Flow

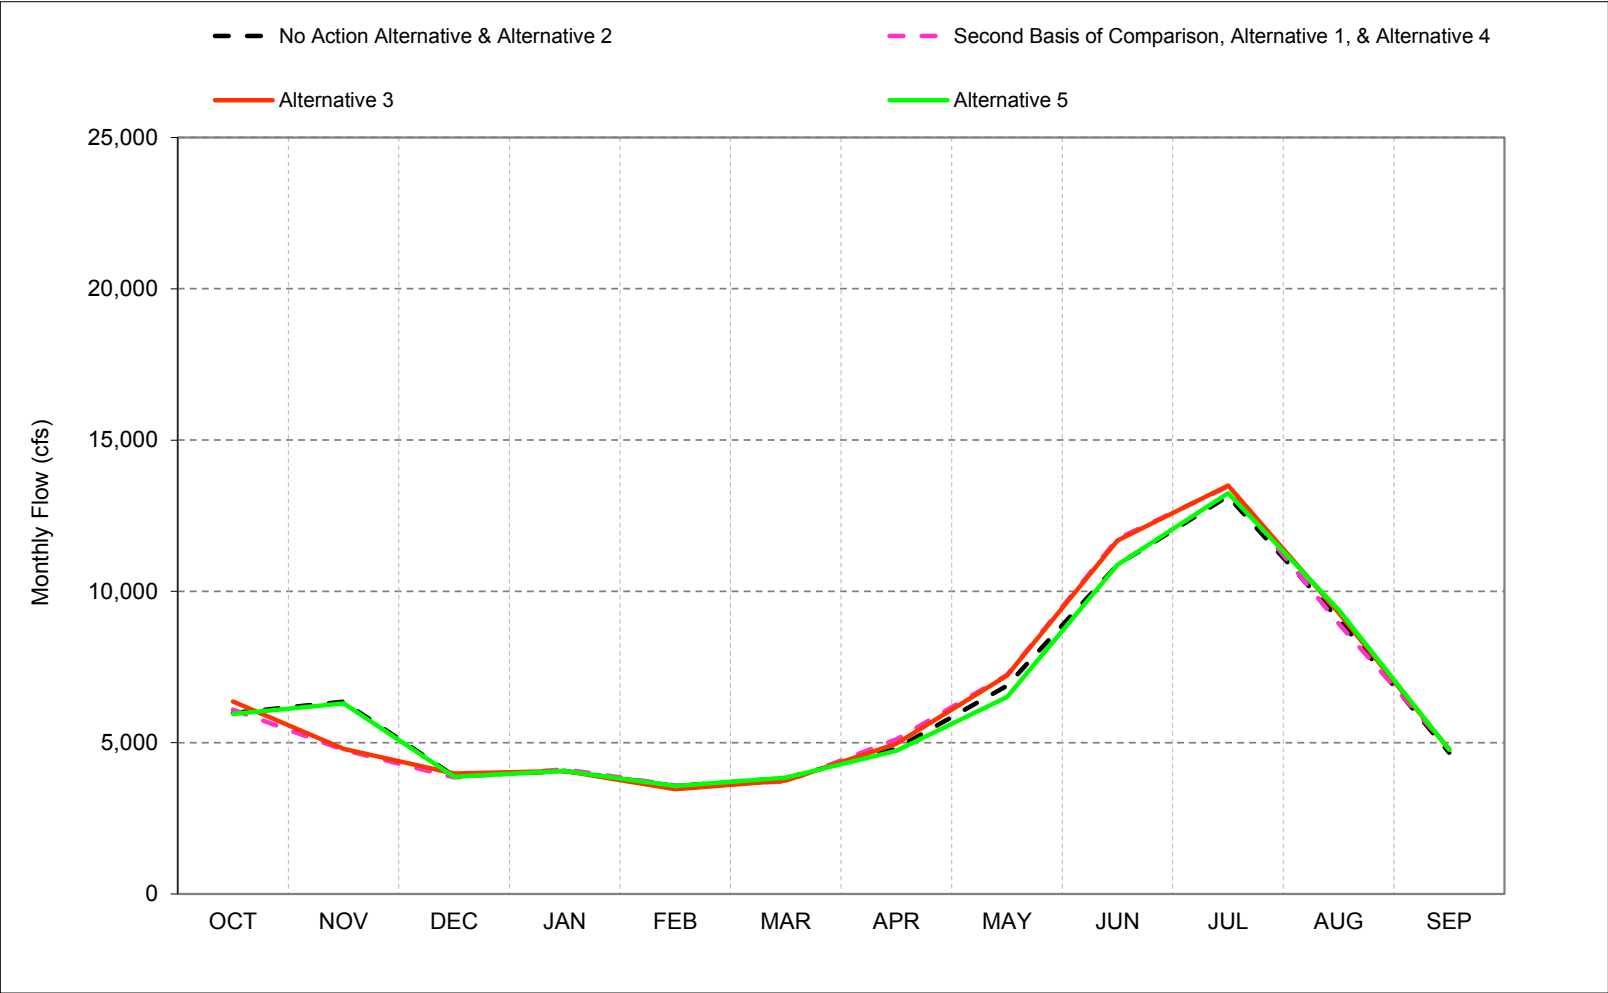


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-23-6. Sacramento River d/s of Keswick Reservoir, Critical Year* Long-Term** Average Flow

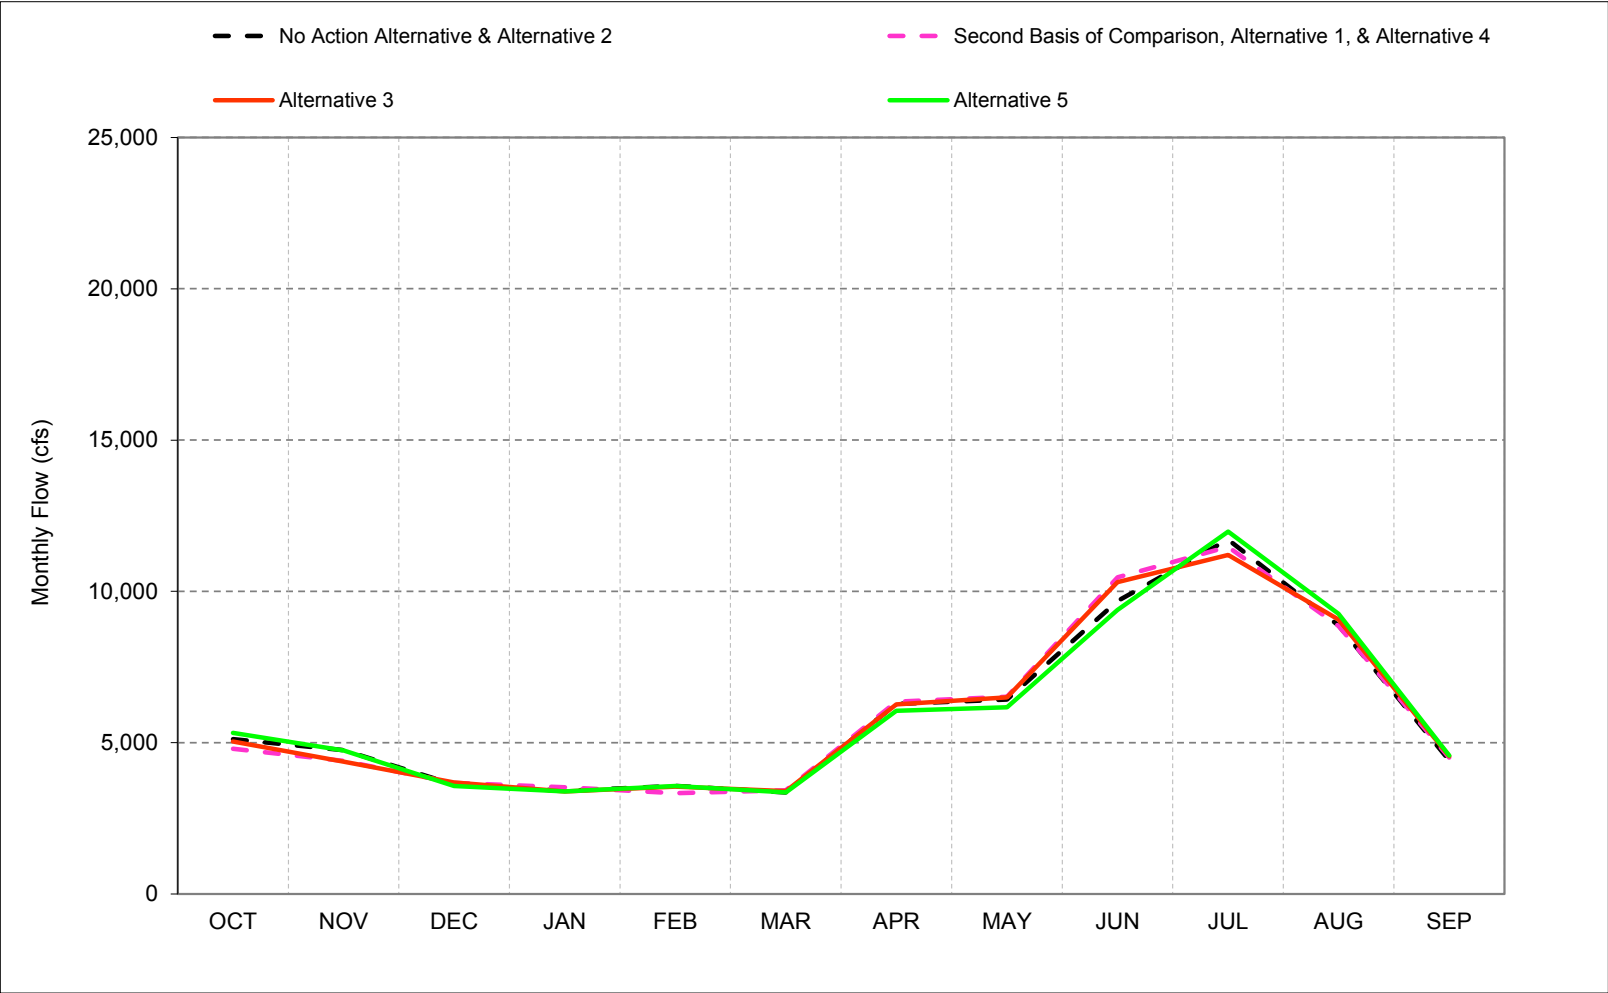

*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-23-1. Sacramento River d/s of Keswick Reservoir, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	8,539	11,351	16,050	19,967	30,773	18,389	10,234	9,624	13,028	15,000	11,592	14,752
20%	7,985	10,020	9,276	12,176	21,412	12,120	7,602	8,744	11,826	15,000	10,909	12,155
30%	7,297	8,317	5,359	7,873	10,878	7,676	6,731	8,256	11,248	15,000	10,724	10,381
40%	6,760	7,008	4,368	4,500	5,039	4,500	5,853	7,615	10,563	14,570	10,286	8,919
50%	5,983	5,888	4,000	4,126	4,500	4,214	5,356	7,192	10,254	13,991	9,978	6,151
60%	5,404	4,822	3,976	3,640	3,565	3,513	5,000	6,503	9,958	13,279	9,568	5,274
70%	5,001	4,379	3,524	3,251	3,250	3,250	4,500	6,168	9,430	12,770	9,152	4,693
80%	4,618	4,000	3,253	3,250	3,250	3,250	4,500	5,666	8,828	11,848	8,861	4,391
90%	4,292	3,502	3,250	3,250	3,250	3,250	3,702	5,145	8,406	10,797	8,089	4,145
Long Term												
Full Simulation Period ^b	6,232	6,954	7,064	8,758	11,392	8,318	6,589	7,361	10,520	13,413	9,951	8,038
Water Year Types^c												
Wet (32%)	6,837	8,356	11,995	17,343	20,568	15,965	8,669	8,200	10,089	13,385	10,377	12,981
Above Normal (16%)	6,122	7,147	7,783	7,948	16,181	7,984	6,239	7,340	11,102	14,701	10,545	8,958
Below Normal (13%)	6,600	6,895	4,067	3,778	6,800	4,216	5,660	7,283	11,096	14,296	10,988	5,333
Dry (24%)	5,981	6,359	3,899	4,070	3,569	3,827	4,807	6,887	10,885	13,146	9,085	4,673
Critical (15%)	5,119	4,757	3,621	3,410	3,571	3,360	6,285	6,428	9,683	11,714	8,877	4,418
Alternative 1												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	8,508	7,576	19,509	20,146	30,874	18,571	10,177	10,192	14,534	15,000	12,723	8,971
20%	7,890	6,794	11,462	15,160	21,412	12,718	8,220	9,232	13,041	15,000	11,885	6,409
30%	7,356	5,587	6,088	8,978	13,139	8,359	6,971	8,471	12,242	15,000	11,209	6,029
40%	6,136	5,210	4,329	4,737	5,375	4,500	6,320	7,928	11,433	14,639	10,726	5,666
50%	5,715	4,858	4,000	4,333	4,500	4,500	5,731	7,458	11,014	14,084	10,347	5,475
60%	5,257	4,364	3,949	3,798	3,735	3,668	5,202	7,098	10,374	13,509	9,891	5,246
70%	4,871	4,181	3,674	3,251	3,250	3,250	4,500	6,497	9,974	13,051	9,282	4,637
80%	4,389	4,000	3,275	3,250	3,250	3,250	4,500	6,095	9,209	11,861	8,985	4,312
90%	4,000	3,501	3,250	3,250	3,250	3,250	3,713	5,503	8,402	10,691	8,150	4,147
Long Term												
Full Simulation Period ^b	6,028	5,615	7,660	9,366	11,718	8,569	6,754	7,708	11,203	13,462	10,417	5,836
Water Year Types^c												
Wet (32%)	6,391	6,705	14,039	18,191	20,773	16,037	8,687	8,398	10,243	13,254	11,143	7,306
Above Normal (16%)	5,940	5,801	7,417	9,024	17,709	8,800	6,317	7,789	12,028	14,804	11,351	6,065
Below Normal (13%)	6,491	5,680	4,134	4,805	7,156	5,076	6,127	8,129	12,334	14,533	11,988	5,429
Dry (24%)	6,092	4,768	3,855	4,123	3,591	3,716	5,107	7,240	11,737	13,465	8,939	4,794
Critical (15%)	4,806	4,404	3,675	3,533	3,335	3,431	6,355	6,519	10,465	11,474	8,854	4,513
Alternative 1 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-31	-3,775	3,459	179	101	182	-58	568	1,506	0	1,131	-5,781
20%	-95	-3,227	2,186	2,985	0	598	618	487	1,215	0	976	-5,746
30%	59	-2,731	728	1,105	2,261	682	240	215	994	0	485	-4,352
40%	-624	-1,798	-39	237	336	0	467	313	870	69	440	-3,252
50%	-268	-1,029	0	207	0	286	375	266	760	93	369	-676
60%	-147	-458	-27	158	170	155	202	595	416	230	323	-27
70%	-130	-198	150	0	0	0	0	328	545	281	129	-57
80%	-229	0	23	0	0	0	0	428	381	14	124	-79
90%	-292	0	0	0	0	0	11	358	-4	-106	62	2
Long Term												
Full Simulation Period ^b	-204	-1,340	596	608	326	251	164	347	684	50	466	-2,202
Water Year Types^c												
Wet (32%)	-446	-1,651	2,044	848	205	73	17	198	154	-131	766	-5,675
Above Normal (16%)	-182	-1,346	-366	1,076	1,528	816	78	449	926	103	806	-2,893
Below Normal (13%)	-109	-1,215	67	1,027	356	860	467	846	1,238	238	1,000	96
Dry (24%)	111	-1,591	-44	53	22	-111	300	353	852	319	-146	121
Critical (15%)	-314	-353	54	123	-236	71	70	91	782	-239	-23	96

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
^b Based on the 82-year simulation period.
^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-23-2. Sacramento River d/s of Keswick Reservoir, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	8,539	11,351	16,050	19,967	30,773	18,389	10,234	9,624	13,028	15,000	11,592	14,752
20%	7,985	10,020	9,276	12,176	21,412	12,120	7,602	8,744	11,826	15,000	10,909	12,155
30%	7,297	8,317	5,359	7,873	10,878	7,676	6,731	8,256	11,248	15,000	10,724	10,381
40%	6,760	7,008	4,368	4,500	5,039	4,500	5,853	7,615	10,563	14,570	10,286	8,919
50%	5,983	5,888	4,000	4,126	4,500	4,214	5,356	7,192	10,254	13,991	9,978	6,151
60%	5,404	4,822	3,976	3,640	3,565	3,513	5,000	6,503	9,958	13,279	9,568	5,274
70%	5,001	4,379	3,524	3,251	3,250	3,250	4,500	6,168	9,430	12,770	9,152	4,693
80%	4,618	4,000	3,253	3,250	3,250	3,250	4,500	5,666	8,828	11,848	8,861	4,391
90%	4,292	3,502	3,250	3,250	3,250	3,250	3,702	5,145	8,406	10,797	8,089	4,145
Long Term												
Full Simulation Period ^b	6,232	6,954	7,064	8,758	11,392	8,318	6,589	7,361	10,520	13,413	9,951	8,038
Water Year Types^c												
Wet (32%)	6,837	8,356	11,995	17,343	20,568	15,965	8,669	8,200	10,089	13,385	10,377	12,981
Above Normal (16%)	6,122	7,147	7,783	7,948	16,181	7,984	6,239	7,340	11,102	14,701	10,545	8,958
Below Normal (13%)	6,600	6,895	4,067	3,778	6,800	4,216	5,660	7,283	11,096	14,296	10,988	5,333
Dry (24%)	5,981	6,359	3,899	4,070	3,569	3,827	4,807	6,887	10,885	13,146	9,085	4,673
Critical (15%)	5,119	4,757	3,621	3,410	3,571	3,360	6,285	6,428	9,683	11,714	8,877	4,418
Alternative 3												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	8,508	7,587	19,593	21,351	32,017	18,576	10,175	10,159	14,138	15,000	11,998	8,758
20%	8,095	6,362	11,532	15,117	21,412	12,718	8,146	9,311	13,148	15,000	11,420	7,492
30%	7,291	5,638	5,887	8,978	12,526	8,359	6,954	8,617	12,022	15,000	11,107	6,335
40%	6,536	5,073	4,450	4,500	6,142	4,500	6,056	7,930	11,316	14,717	10,669	5,916
50%	5,729	4,755	4,077	4,184	4,500	4,500	5,368	7,437	10,905	14,368	10,087	5,590
60%	5,223	4,361	3,976	3,706	3,565	3,547	5,053	7,055	10,464	13,336	9,838	5,137
70%	4,867	4,160	3,655	3,250	3,250	3,250	4,500	6,478	10,022	12,638	9,556	4,817
80%	4,503	4,000	3,294	3,250	3,250	3,250	4,500	6,060	9,302	11,876	8,943	4,361
90%	4,114	3,501	3,250	3,250	3,250	3,250	3,717	5,503	8,397	10,803	8,489	4,186
Long Term												
Full Simulation Period ^b	6,130	5,556	7,692	9,315	11,713	8,592	6,689	7,706	11,131	13,440	10,268	6,083
Water Year Types^c												
Wet (32%)	6,352	6,595	14,028	18,268	20,814	16,038	8,692	8,405	10,360	13,341	10,845	7,512
Above Normal (16%)	6,088	5,850	7,442	8,771	17,594	8,923	6,263	7,839	11,793	14,732	10,881	6,029
Below Normal (13%)	6,415	5,424	4,116	4,781	7,144	5,061	6,045	8,088	12,075	14,472	11,247	6,827
Dry (24%)	6,362	4,793	3,982	4,073	3,468	3,755	4,970	7,223	11,682	13,500	9,299	4,770
Critical (15%)	5,047	4,375	3,694	3,396	3,555	3,398	6,266	6,501	10,302	11,206	9,074	4,555
Alternative 3 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-31	-3,764	3,543	1,383	1,245	187	-59	535	1,110	0	406	-5,995
20%	110	-3,659	2,256	2,941	0	598	544	567	1,322	0	510	-4,663
30%	-6	-2,680	528	1,105	1,648	682	223	361	774	0	383	-4,047
40%	-224	-1,935	82	0	1,102	0	203	315	754	147	383	-3,002
50%	-254	-1,133	77	57	0	286	13	246	651	377	109	-561
60%	-181	-461	0	66	0	34	52	552	506	57	270	-137
70%	-134	-219	131	-1	0	0	0	310	592	-132	404	123
80%	-116	0	42	0	0	0	0	393	474	29	81	-29
90%	-178	0	0	0	0	0	15	357	-9	6	401	42
Long Term												
Full Simulation Period ^b	-102	-1,399	628	557	321	273	100	345	612	27	318	-1,954
Water Year Types^c												
Wet (32%)	-485	-1,760	2,033	925	246	73	23	205	270	-44	468	-5,469
Above Normal (16%)	-34	-1,296	-341	823	1,413	939	24	499	692	32	336	-2,929
Below Normal (13%)	-186	-1,472	49	1,002	344	845	385	805	979	176	258	1,493
Dry (24%)	381	-1,566	84	3	-101	-72	163	337	797	355	215	97
Critical (15%)	-73	-382	73	-14	-16	38	-19	73	618	-508	197	137

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
^b Based on the 82-year simulation period.
^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-23-3. Sacramento River d/s of Keswick Reservoir, Monthly Flow

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	8,539	11,351	16,050	19,967	30,773	18,389	10,234	9,624	13,028	15,000	11,592	14,752
20%	7,985	10,020	9,276	12,176	21,412	12,120	7,602	8,744	11,826	15,000	10,909	12,155
30%	7,297	8,317	5,359	7,873	10,878	7,676	6,731	8,256	11,248	15,000	10,724	10,381
40%	6,760	7,008	4,368	4,500	5,039	4,500	5,853	7,615	10,563	14,570	10,286	8,919
50%	5,983	5,888	4,000	4,126	4,500	4,214	5,356	7,192	10,254	13,991	9,978	6,151
60%	5,404	4,822	3,976	3,640	3,565	3,513	5,000	6,503	9,958	13,279	9,568	5,274
70%	5,001	4,379	3,524	3,251	3,250	3,250	4,500	6,168	9,430	12,770	9,152	4,693
80%	4,618	4,000	3,253	3,250	3,250	3,250	4,500	5,666	8,828	11,848	8,861	4,391
90%	4,292	3,502	3,250	3,250	3,250	3,250	3,702	5,145	8,406	10,797	8,089	4,145
Long Term												
Full Simulation Period ^b	6,232	6,954	7,064	8,758	11,392	8,318	6,589	7,361	10,520	13,413	9,951	8,038
Water Year Types ^c												
Wet (32%)	6,837	8,356	11,995	17,343	20,568	15,965	8,669	8,200	10,089	13,385	10,377	12,981
Above Normal (16%)	6,122	7,147	7,783	7,948	16,181	7,984	6,239	7,340	11,102	14,701	10,545	8,958
Below Normal (13%)	6,600	6,895	4,067	3,778	6,800	4,216	5,660	7,283	11,096	14,296	10,988	5,333
Dry (24%)	5,981	6,359	3,899	4,070	3,569	3,827	4,807	6,887	10,885	13,146	9,085	4,673
Critical (15%)	5,119	4,757	3,621	3,410	3,571	3,360	6,285	6,428	9,683	11,714	8,877	4,418

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	8,668	11,324	15,764	19,967	30,605	18,389	10,163	9,387	12,940	15,000	11,641	14,750
20%	7,868	10,000	9,191	12,163	21,412	12,271	7,595	8,527	11,910	15,000	11,065	11,992
30%	7,258	8,490	5,272	7,912	10,813	7,676	6,656	7,950	11,187	15,000	10,814	10,346
40%	6,651	7,099	4,275	4,500	5,039	4,500	5,875	7,559	10,628	14,598	10,451	8,736
50%	5,959	5,836	4,000	4,126	4,500	4,214	5,314	7,068	10,168	14,173	10,062	5,933
60%	5,518	4,834	3,975	3,671	3,565	3,547	5,003	6,436	9,875	13,393	9,635	5,357
70%	5,048	4,341	3,522	3,250	3,250	3,250	4,500	6,075	9,405	12,954	9,326	4,944
80%	4,818	4,000	3,253	3,250	3,250	3,250	4,500	5,822	8,795	11,851	8,818	4,505
90%	4,427	3,483	3,250	3,250	3,250	3,250	3,702	5,146	8,384	10,611	8,326	4,231
Long Term												
Full Simulation Period ^b	6,247	6,952	7,033	8,765	11,399	8,336	6,545	7,214	10,464	13,490	10,050	8,082
Water Year Types ^c												
Wet (32%)	6,770	8,471	11,936	17,340	20,582	15,979	8,670	8,203	10,080	13,420	10,387	12,950
Above Normal (16%)	6,222	7,015	7,819	7,984	16,119	8,008	6,238	7,262	11,075	14,723	10,501	8,858
Below Normal (13%)	6,583	6,886	4,038	3,814	6,882	4,245	5,705	7,231	11,063	14,293	10,767	5,512
Dry (24%)	5,947	6,300	3,874	4,070	3,576	3,848	4,737	6,509	10,882	13,247	9,397	4,768
Critical (15%)	5,330	4,741	3,569	3,396	3,569	3,363	6,060	6,177	9,388	11,977	9,259	4,574

Alternative 5 minus No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	128	-26	-286	0	-167	0	-71	-237	-88	0	49	-2
20%	-117	-20	-85	-13	0	151	-7	-217	84	0	156	-163
30%	-39	172	-87	39	-65	0	-75	-306	-61	0	90	-36
40%	-108	91	-93	0	0	0	22	-56	65	28	165	-183
50%	-24	-51	0	0	0	0	-42	-124	-86	181	84	-218
60%	114	12	0	30	0	34	3	-67	-83	114	67	84
70%	47	-38	-2	-1	0	0	0	-93	-24	184	173	251
80%	200	0	0	0	0	0	0	156	-33	3	-44	114
90%	136	-19	0	0	0	0	0	0	-22	-187	237	87
Long Term												
Full Simulation Period ^b	15	-2	-31	8	7	18	-44	-147	-56	78	99	44
Water Year Types ^c												
Wet (32%)	-67	115	-59	-3	14	15	0	3	-10	36	10	-31
Above Normal (16%)	100	-132	36	36	-62	24	-1	-78	-27	23	-43	-100
Below Normal (13%)	-18	-10	-29	36	82	29	46	-52	-33	-3	-221	179
Dry (24%)	-33	-59	-25	0	7	21	-70	-378	-3	101	312	94
Critical (15%)	210	-16	-52	-14	-2	3	-225	-251	-295	263	381	157

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-23-4. Sacramento River d/s of Keswick Reservoir, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	8,508	7,576	19,509	20,146	30,874	18,571	10,177	10,192	14,534	15,000	12,723	8,971
20%	7,890	6,794	11,462	15,160	21,412	12,718	8,220	9,232	13,041	15,000	11,885	6,409
30%	7,356	5,587	6,088	8,978	13,139	8,359	6,971	8,471	12,242	15,000	11,209	6,029
40%	6,136	5,210	4,329	4,737	5,375	4,500	6,320	7,928	11,433	14,639	10,726	5,666
50%	5,715	4,858	4,000	4,333	4,500	4,500	5,731	7,458	11,014	14,084	10,347	5,475
60%	5,257	4,364	3,949	3,798	3,735	3,668	5,202	7,098	10,374	13,509	9,891	5,246
70%	4,871	4,181	3,674	3,251	3,250	3,250	4,500	6,497	9,974	13,051	9,282	4,637
80%	4,389	4,000	3,275	3,250	3,250	3,250	4,500	6,095	9,209	11,861	8,985	4,312
90%	4,000	3,501	3,250	3,250	3,250	3,250	3,713	5,503	8,402	10,691	8,150	4,147
Long Term												
Full Simulation Period ^b	6,028	5,615	7,660	9,366	11,718	8,569	6,754	7,708	11,203	13,462	10,417	5,836
Water Year Types^c												
Wet (32%)	6,391	6,705	14,039	18,191	20,773	16,037	8,687	8,398	10,243	13,254	11,143	7,306
Above Normal (16%)	5,940	5,801	7,417	9,024	17,709	8,800	6,317	7,789	12,028	14,804	11,351	6,065
Below Normal (13%)	6,491	5,680	4,134	4,805	7,156	5,076	6,127	8,129	12,334	14,533	11,988	5,429
Dry (24%)	6,092	4,768	3,855	4,123	3,591	3,716	5,107	7,240	11,737	13,465	8,939	4,794
Critical (15%)	4,806	4,404	3,675	3,533	3,335	3,431	6,355	6,519	10,465	11,474	8,854	4,513

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	8,539	11,351	16,050	19,967	30,773	18,389	10,234	9,624	13,028	15,000	11,592	14,752
20%	7,985	10,020	9,276	12,176	21,412	12,120	7,602	8,744	11,826	15,000	10,909	12,155
30%	7,297	8,317	5,359	7,873	10,878	7,676	6,731	8,256	11,248	15,000	10,724	10,381
40%	6,760	7,008	4,368	4,500	5,039	4,500	5,853	7,615	10,563	14,570	10,286	8,919
50%	5,983	5,888	4,000	4,126	4,500	4,214	5,356	7,192	10,254	13,991	9,978	6,151
60%	5,404	4,822	3,976	3,640	3,565	3,513	5,000	6,503	9,958	13,279	9,568	5,274
70%	5,001	4,379	3,524	3,251	3,250	3,250	4,500	6,168	9,430	12,770	9,152	4,693
80%	4,618	4,000	3,253	3,250	3,250	3,250	4,500	5,666	8,828	11,848	8,861	4,391
90%	4,292	3,502	3,250	3,250	3,250	3,250	3,702	5,145	8,406	10,797	8,089	4,145
Long Term												
Full Simulation Period ^b	6,232	6,954	7,064	8,758	11,392	8,318	6,589	7,361	10,520	13,413	9,951	8,038
Water Year Types^c												
Wet (32%)	6,837	8,356	11,995	17,343	20,568	15,965	8,669	8,200	10,089	13,385	10,377	12,981
Above Normal (16%)	6,122	7,147	7,783	7,948	16,181	7,984	6,239	7,340	11,102	14,701	10,545	8,958
Below Normal (13%)	6,600	6,895	4,067	3,778	6,800	4,216	5,660	7,283	11,096	14,296	10,988	5,333
Dry (24%)	5,981	6,359	3,899	4,070	3,569	3,827	4,807	6,887	10,885	13,146	9,085	4,673
Critical (15%)	5,119	4,757	3,621	3,410	3,571	3,360	6,285	6,428	9,683	11,714	8,877	4,418

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	31	3,775	-3,459	-179	-101	-182	58	-568	-1,506	0	-1,131	5,781
20%	95	3,227	-2,186	-2,985	0	-598	-618	-487	-1,215	0	-976	5,746
30%	-59	2,731	-728	-1,105	-2,261	-682	-240	-215	-994	0	-485	4,352
40%	624	1,798	39	-237	-336	0	-467	-313	-870	-69	-440	3,252
50%	268	1,029	0	-207	0	-286	-375	-266	-760	-93	-369	676
60%	147	458	27	-158	-170	-155	-202	-595	-416	-230	-323	27
70%	130	198	-150	0	0	0	0	-328	-545	-281	-129	57
80%	229	0	-23	0	0	0	0	-428	-381	-14	-124	79
90%	292	0	0	0	0	0	-11	-358	4	106	-62	-2
Long Term												
Full Simulation Period ^b	204	1,340	-596	-608	-326	-251	-164	-347	-684	-50	-466	2,202
Water Year Types^c												
Wet (32%)	446	1,651	-2,044	-848	-205	-73	-17	-198	-154	131	-766	5,675
Above Normal (16%)	182	1,346	366	-1,076	-1,528	-816	-78	-449	-926	-103	-806	2,893
Below Normal (13%)	109	1,215	-67	-1,027	-356	-860	-467	-846	-1,238	-238	-1,000	-96
Dry (24%)	-111	1,591	44	-53	-22	111	-300	-353	-852	-319	146	-121
Critical (15%)	314	353	-54	-123	236	-71	-70	-91	-782	239	23	-96

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-23-5. Sacramento River d/s of Keswick Reservoir, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	8,508	7,576	19,509	20,146	30,874	18,571	10,177	10,192	14,534	15,000	12,723	8,971
20%	7,890	6,794	11,462	15,160	21,412	12,718	8,220	9,232	13,041	15,000	11,885	6,409
30%	7,356	5,587	6,088	8,978	13,139	8,359	6,971	8,471	12,242	15,000	11,209	6,029
40%	6,136	5,210	4,329	4,737	5,375	4,500	6,320	7,928	11,433	14,639	10,726	5,666
50%	5,715	4,858	4,000	4,333	4,500	4,500	5,731	7,458	11,014	14,084	10,347	5,475
60%	5,257	4,364	3,949	3,798	3,735	3,668	5,202	7,098	10,374	13,509	9,891	5,246
70%	4,871	4,181	3,674	3,251	3,250	3,250	4,500	6,497	9,974	13,051	9,282	4,637
80%	4,389	4,000	3,275	3,250	3,250	3,250	4,500	6,095	9,209	11,861	8,985	4,312
90%	4,000	3,501	3,250	3,250	3,250	3,250	3,713	5,503	8,402	10,691	8,150	4,147
Long Term												
Full Simulation Period ^b	6,028	5,615	7,660	9,366	11,718	8,569	6,754	7,708	11,203	13,462	10,417	5,836
Water Year Types^c												
Wet (32%)	6,391	6,705	14,039	18,191	20,773	16,037	8,687	8,398	10,243	13,254	11,143	7,306
Above Normal (16%)	5,940	5,801	7,417	9,024	17,709	8,800	6,317	7,789	12,028	14,804	11,351	6,065
Below Normal (13%)	6,491	5,680	4,134	4,805	7,156	5,076	6,127	8,129	12,334	14,533	11,988	5,429
Dry (24%)	6,092	4,768	3,855	4,123	3,591	3,716	5,107	7,240	11,737	13,465	8,939	4,794
Critical (15%)	4,806	4,404	3,675	3,533	3,335	3,431	6,355	6,519	10,465	11,474	8,854	4,513

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	8,508	7,587	19,593	21,351	32,017	18,576	10,175	10,159	14,138	15,000	11,998	8,758
20%	8,095	6,362	11,532	15,117	21,412	12,718	8,146	9,311	13,148	15,000	11,420	7,492
30%	7,291	5,638	5,887	8,978	12,526	8,359	6,954	8,617	12,022	15,000	11,107	6,335
40%	6,536	5,073	4,450	4,500	6,142	4,500	6,056	7,930	11,316	14,717	10,669	5,916
50%	5,729	4,755	4,077	4,184	4,500	4,500	5,368	7,437	10,905	14,368	10,087	5,590
60%	5,223	4,361	3,976	3,706	3,565	3,547	5,053	7,055	10,464	13,336	9,838	5,137
70%	4,867	4,160	3,655	3,250	3,250	3,250	4,500	6,478	10,022	12,638	9,556	4,817
80%	4,503	4,000	3,294	3,250	3,250	3,250	4,500	6,060	9,302	11,876	8,943	4,361
90%	4,114	3,501	3,250	3,250	3,250	3,250	3,717	5,503	8,397	10,803	8,489	4,186
Long Term												
Full Simulation Period ^b	6,130	5,556	7,692	9,315	11,713	8,592	6,689	7,706	11,131	13,440	10,268	6,083
Water Year Types^c												
Wet (32%)	6,352	6,595	14,028	18,268	20,814	16,038	8,692	8,405	10,360	13,341	10,845	7,512
Above Normal (16%)	6,088	5,850	7,442	8,771	17,594	8,923	6,263	7,839	11,793	14,732	10,881	6,029
Below Normal (13%)	6,415	5,424	4,116	4,781	7,144	5,061	6,045	8,088	12,075	14,472	11,247	6,827
Dry (24%)	6,362	4,793	3,982	4,073	3,468	3,755	4,970	7,223	11,682	13,500	9,299	4,770
Critical (15%)	5,047	4,375	3,694	3,396	3,555	3,398	6,266	6,501	10,302	11,206	9,074	4,555

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	11	84	1,205	1,143	5	-2	-33	-395	0	-725	-213
20%	205	-432	70	-44	0	0	-74	79	107	0	-465	1,083
30%	-65	51	-201	0	-613	0	-17	146	-220	0	-102	305
40%	400	-136	121	-237	766	0	-264	2	-117	78	-56	250
50%	14	-103	77	-150	0	0	-362	-21	-109	284	-260	114
60%	-34	-3	27	-92	-170	-121	-149	-43	90	-173	-53	-109
70%	-4	-20	-19	-1	0	0	0	-18	47	-413	275	180
80%	113	0	19	0	0	0	0	-35	93	15	-42	50
90%	114	0	0	0	0	0	4	0	-6	112	339	39
Long Term												
Full Simulation Period ^b	102	-59	32	-51	-5	22	-64	-2	-72	-23	-148	247
Water Year Types^c												
Wet (32%)	-38	-109	-11	78	41	0	5	7	116	87	-298	206
Above Normal (16%)	148	50	25	-253	-115	123	-54	50	-235	-72	-470	-36
Below Normal (13%)	-76	-256	-18	-24	-12	-15	-82	-41	-259	-61	-742	1,398
Dry (24%)	270	25	128	-50	-123	39	-137	-16	-55	36	360	-24
Critical (15%)	241	-29	18	-137	220	-33	-89	-18	-164	-269	221	41

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-23-6. Sacramento River d/s of Keswick Reservoir, Monthly Flow

Second Basis of Comparison												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	8,508	7,576	19,509	20,146	30,874	18,571	10,177	10,192	14,534	15,000	12,723	8,971
20%	7,890	6,794	11,462	15,160	21,412	12,718	8,220	9,232	13,041	15,000	11,885	6,409
30%	7,356	5,587	6,088	8,978	13,139	8,359	6,971	8,471	12,242	15,000	11,209	6,029
40%	6,136	5,210	4,329	4,737	5,375	4,500	6,320	7,928	11,433	14,639	10,726	5,666
50%	5,715	4,858	4,000	4,333	4,500	4,500	5,731	7,458	11,014	14,084	10,347	5,475
60%	5,257	4,364	3,949	3,798	3,735	3,668	5,202	7,098	10,374	13,509	9,891	5,246
70%	4,871	4,181	3,674	3,251	3,250	3,250	4,500	6,497	9,974	13,051	9,282	4,637
80%	4,389	4,000	3,275	3,250	3,250	3,250	4,500	6,095	9,209	11,861	8,985	4,312
90%	4,000	3,501	3,250	3,250	3,250	3,250	3,713	5,503	8,402	10,691	8,150	4,147
Long Term												
Full Simulation Period ^b	6,028	5,615	7,660	9,366	11,718	8,569	6,754	7,708	11,203	13,462	10,417	5,836
Water Year Types^c												
Wet (32%)	6,391	6,705	14,039	18,191	20,773	16,037	8,687	8,398	10,243	13,254	11,143	7,306
Above Normal (16%)	5,940	5,801	7,417	9,024	17,709	8,800	6,317	7,789	12,028	14,804	11,351	6,065
Below Normal (13%)	6,491	5,680	4,134	4,805	7,156	5,076	6,127	8,129	12,334	14,533	11,988	5,429
Dry (24%)	6,092	4,768	3,855	4,123	3,591	3,716	5,107	7,240	11,737	13,465	8,939	4,794
Critical (15%)	4,806	4,404	3,675	3,533	3,335	3,431	6,355	6,519	10,465	11,474	8,854	4,513


Alternative 5												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	8,668	11,324	15,764	19,967	30,605	18,389	10,163	9,387	12,940	15,000	11,641	14,750
20%	7,868	10,000	9,191	12,163	21,412	12,271	7,595	8,527	11,910	15,000	11,065	11,992
30%	7,258	8,490	5,272	7,912	10,813	7,676	6,656	7,950	11,187	15,000	10,814	10,346
40%	6,651	7,099	4,275	4,500	5,039	4,500	5,875	7,559	10,628	14,598	10,451	8,736
50%	5,959	5,836	4,000	4,126	4,500	4,214	5,314	7,068	10,168	14,173	10,062	5,933
60%	5,518	4,834	3,975	3,671	3,565	3,547	5,003	6,436	9,875	13,393	9,635	5,357
70%	5,048	4,341	3,522	3,250	3,250	3,250	4,500	6,075	9,405	12,954	9,326	4,944
80%	4,818	4,000	3,253	3,250	3,250	3,250	4,500	5,822	8,795	11,851	8,818	4,505
90%	4,427	3,483	3,250	3,250	3,250	3,250	3,702	5,146	8,384	10,611	8,326	4,231
Long Term												
Full Simulation Period ^b	6,247	6,952	7,033	8,765	11,399	8,336	6,545	7,214	10,464	13,490	10,050	8,082
Water Year Types^c												
Wet (32%)	6,770	8,471	11,936	17,340	20,582	15,979	8,670	8,203	10,080	13,420	10,387	12,950
Above Normal (16%)	6,222	7,015	7,819	7,984	16,119	8,008	6,238	7,262	11,075	14,723	10,501	8,858
Below Normal (13%)	6,583	6,886	4,038	3,814	6,882	4,245	5,705	7,231	11,063	14,293	10,767	5,512
Dry (24%)	5,947	6,300	3,874	4,070	3,576	3,848	4,737	6,509	10,882	13,247	9,397	4,768
Critical (15%)	5,330	4,741	3,569	3,396	3,569	3,363	6,060	6,177	9,388	11,977	9,259	4,574

Alternative 5 minus Second Basis of Comparison												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	159	3,749	-3,745	-179	-269	-182	-14	-805	-1,594	0	-1,082	5,779
20%	-22	3,206	-2,271	-2,998	0	-447	-625	-704	-1,131	0	-820	5,583
30%	-98	2,903	-816	-1,065	-2,326	-682	-315	-521	-1,055	0	-395	4,316
40%	515	1,889	-54	-237	-336	0	-445	-369	-805	-41	-275	3,070
50%	244	978	0	-207	0	-286	-417	-390	-845	88	-285	458
60%	261	470	26	-127	-170	-121	-199	-661	-499	-116	-256	111
70%	177	160	-152	-1	0	0	0	-421	-569	-97	44	307
80%	429	0	-23	0	0	0	0	-272	-414	-11	-167	193
90%	427	-19	0	0	0	0	-11	-357	-18	-81	175	84
Long Term												
Full Simulation Period ^b	219	1,337	-627	-600	-319	-233	-208	-494	-740	28	-367	2,246
Water Year Types^c												
Wet (32%)	380	1,766	-2,103	-850	-191	-58	-17	-195	-164	166	-756	5,644
Above Normal (16%)	283	1,214	403	-1,040	-1,590	-792	-79	-527	-953	-81	-850	2,793
Below Normal (13%)	92	1,206	-96	-991	-274	-831	-422	-897	-1,271	-241	-1,221	83
Dry (24%)	-144	1,532	19	-53	-15	132	-370	-731	-855	-218	458	-26
Critical (15%)	524	337	-107	-137	235	-68	-295	-342	-1,077	502	405	61

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
^b Based on the 82-year simulation period.
^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1 **C.24. Sacramento River Flow at Bend Bridge**


Figure C-24-1. Sacramento River at Bend Bridge, Long-Term* Average Flow

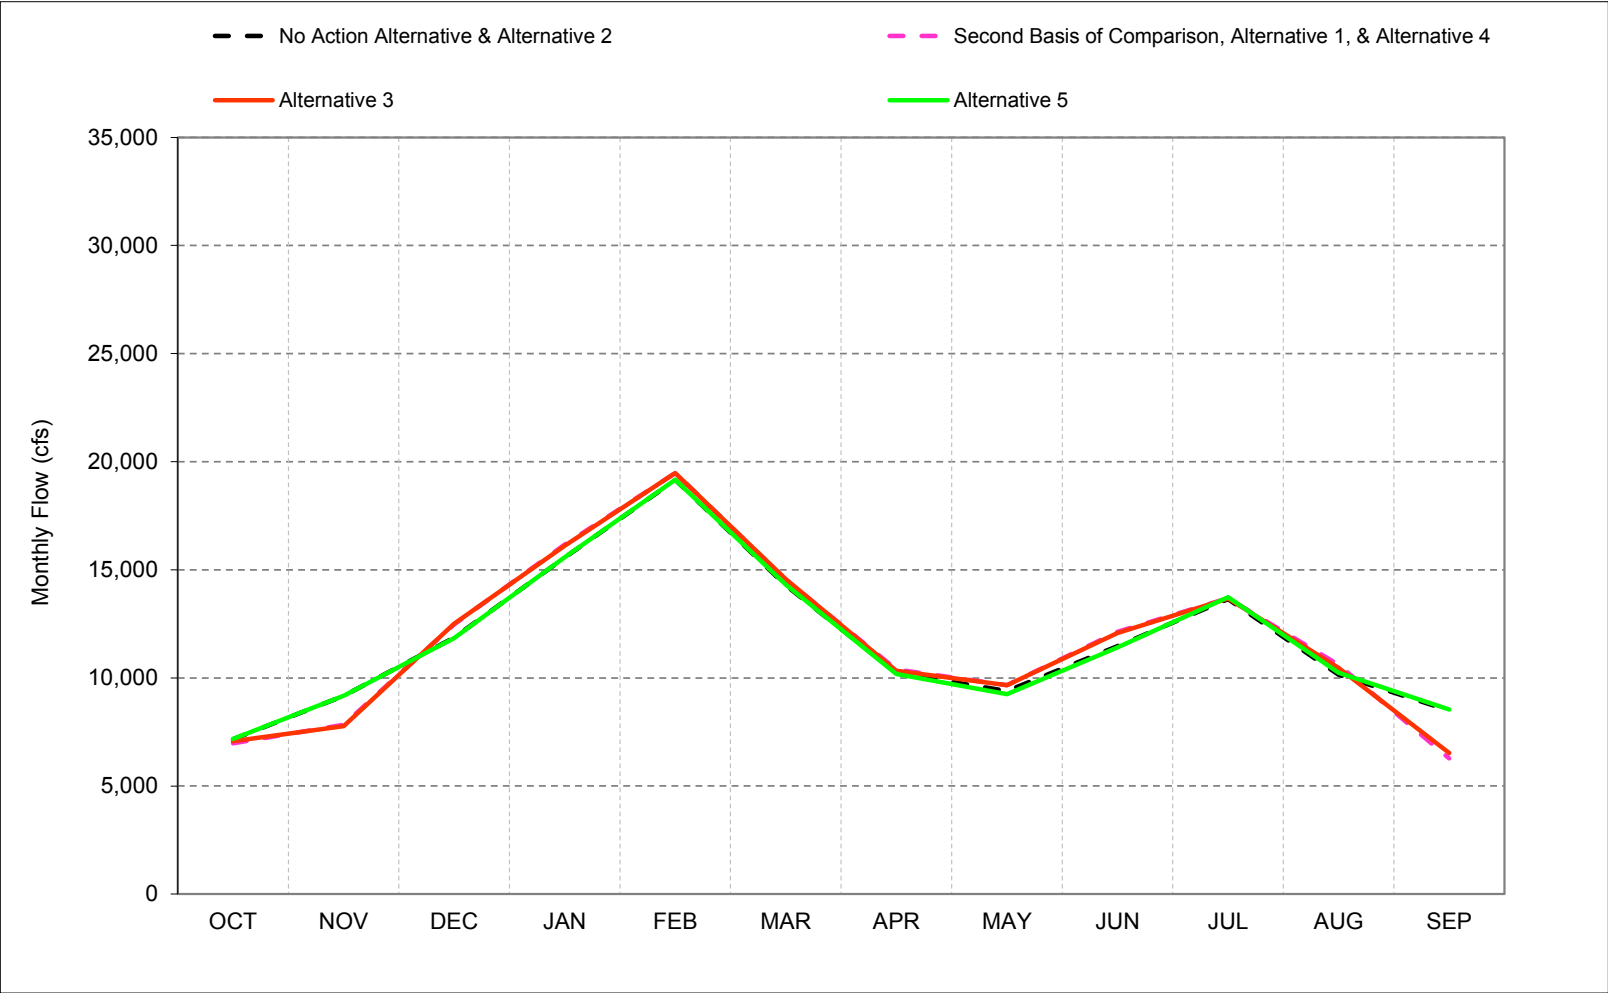

*Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-24-2. Sacramento River at Bend Bridge, Wet Year* Long-Term** Average Flow

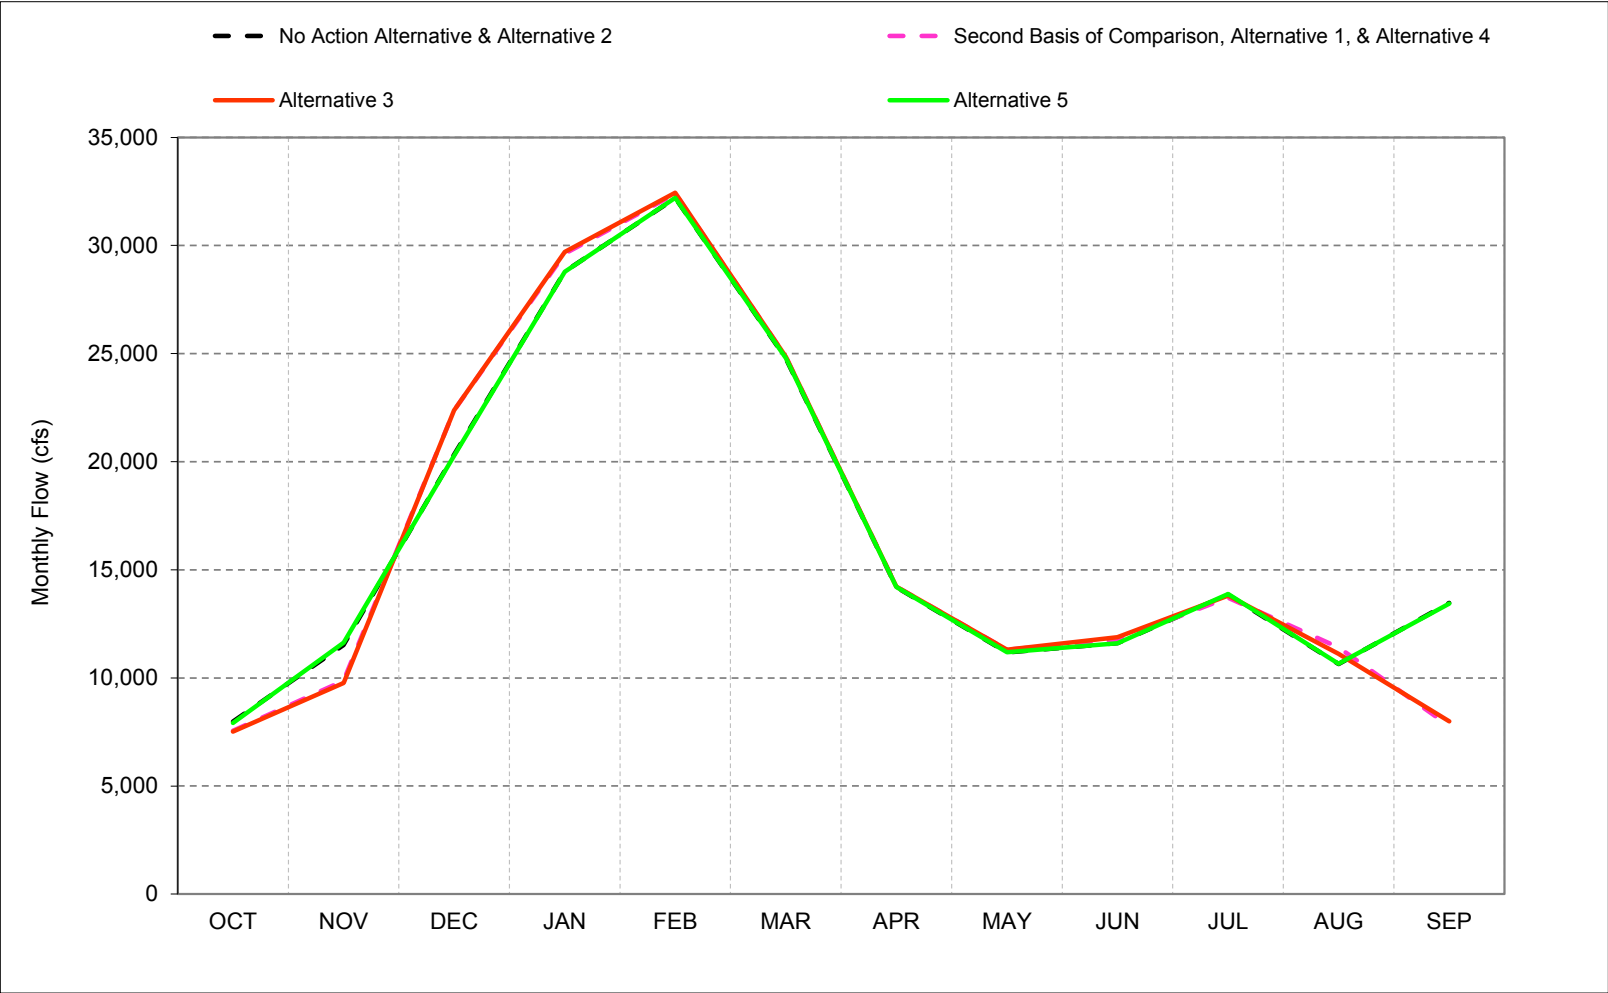


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-24-3. Sacramento River at Bend Bridge, Above Normal Year* Long-Term** Average Flow

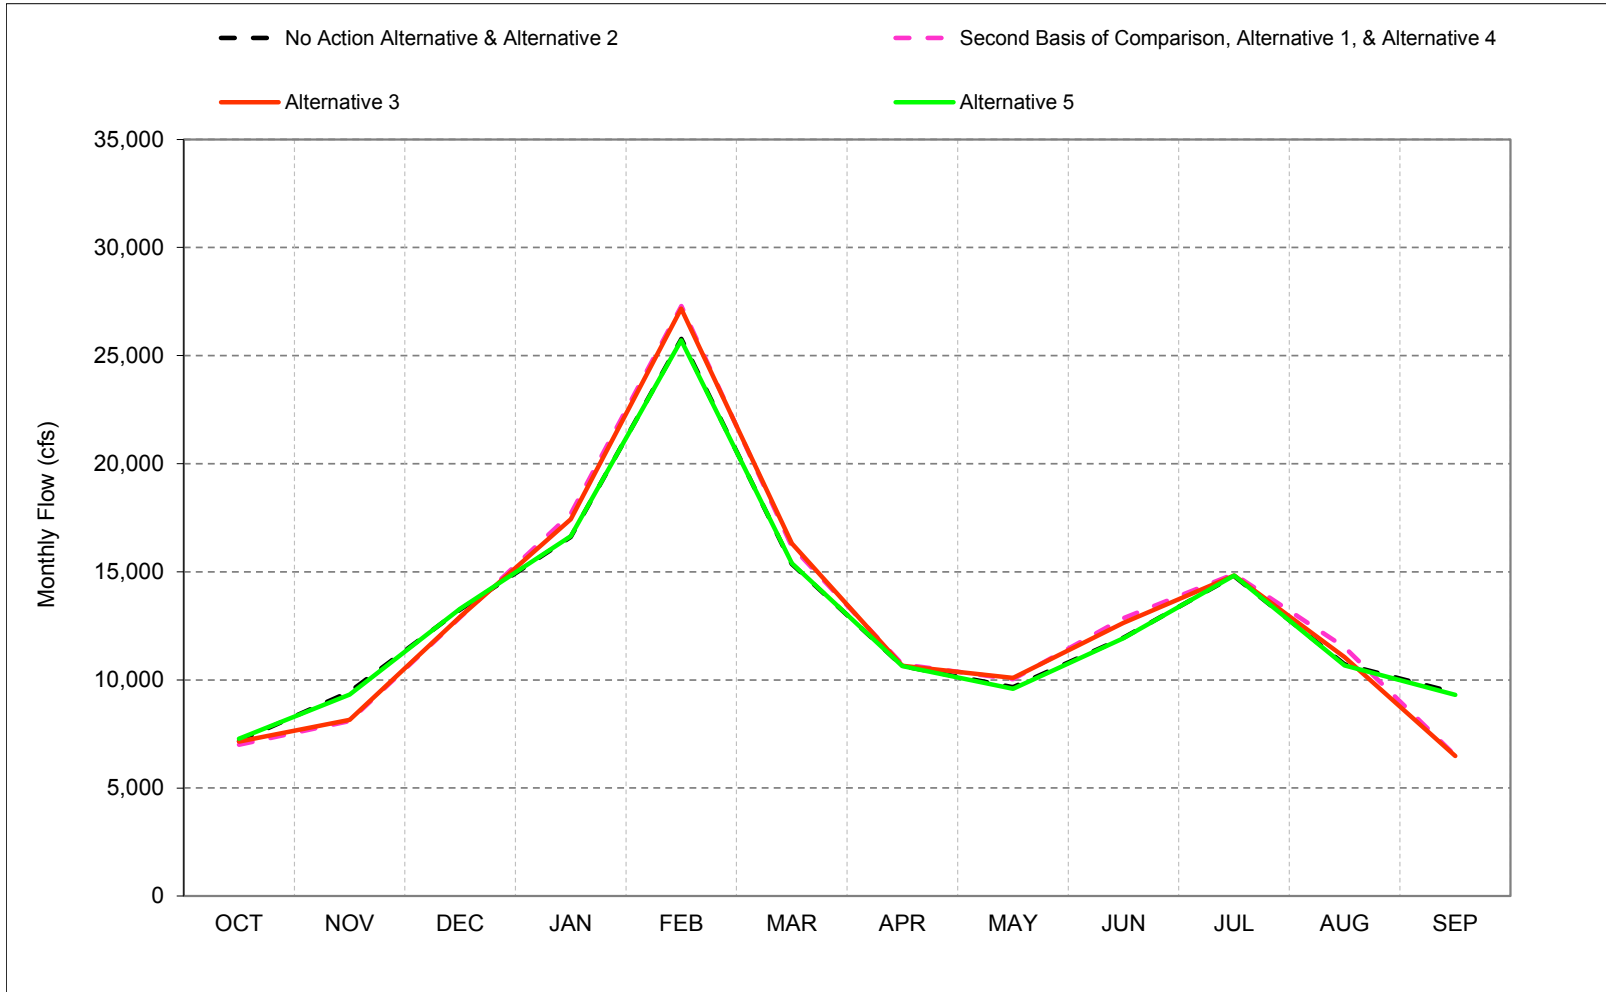


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-24-4. Sacramento River at Bend Bridge, Below Normal Year* Long-Term** Average Flow

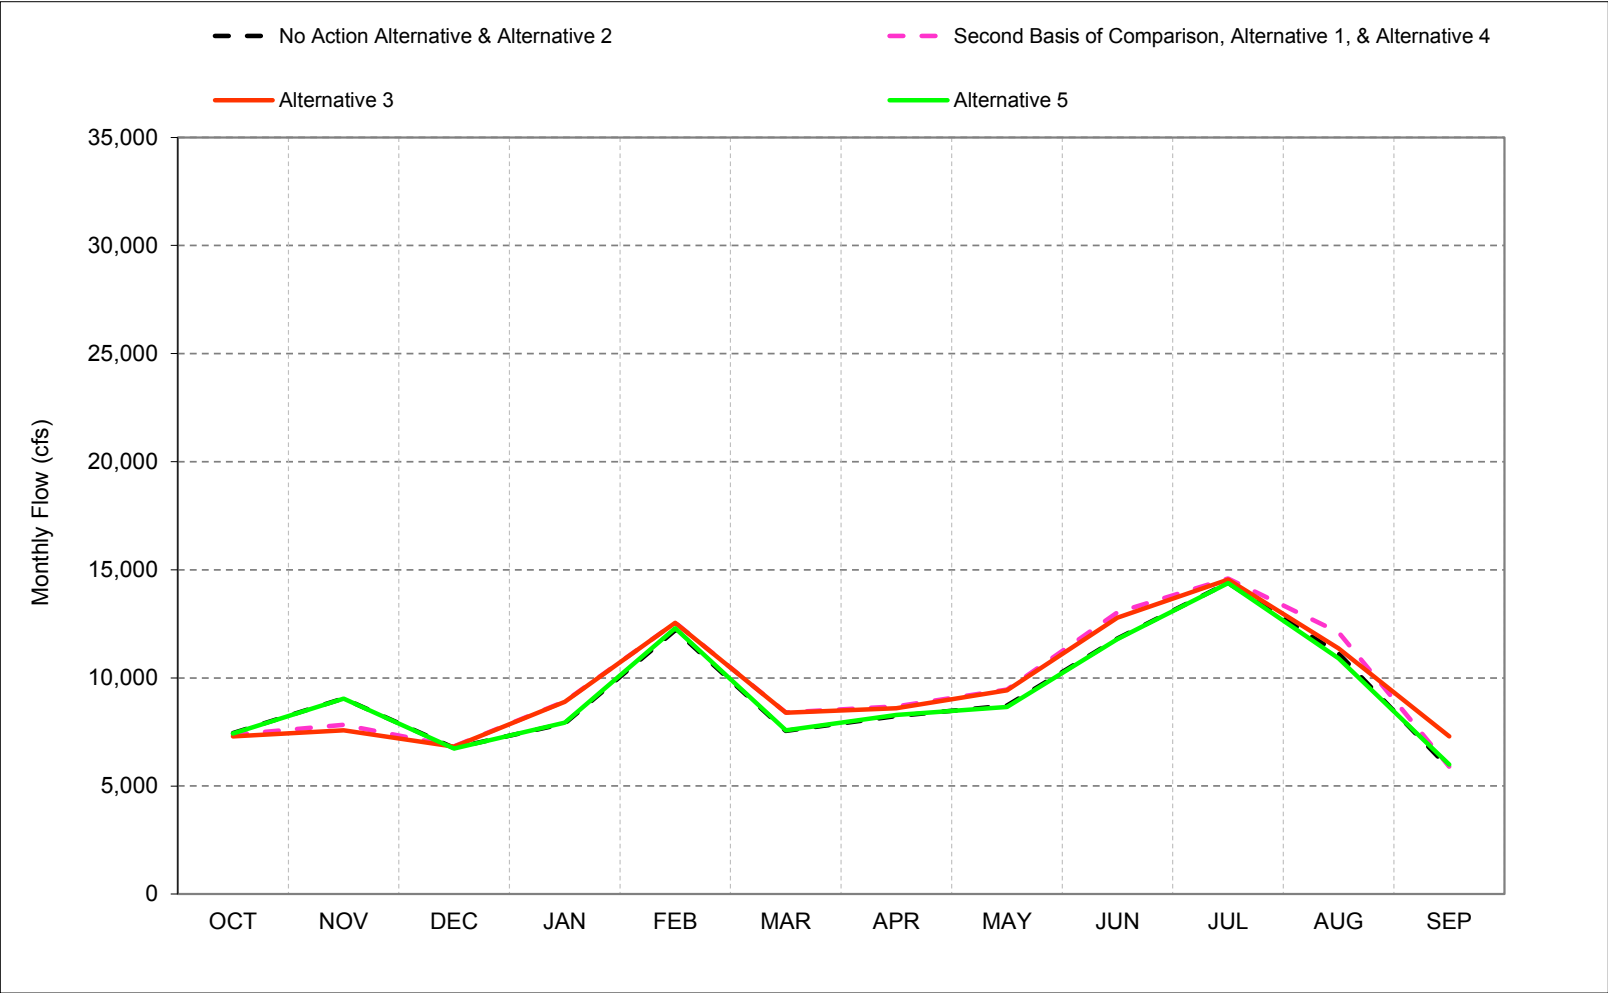


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-24-5. Sacramento River at Bend Bridge, Dry Year* Long-Term** Average Flow

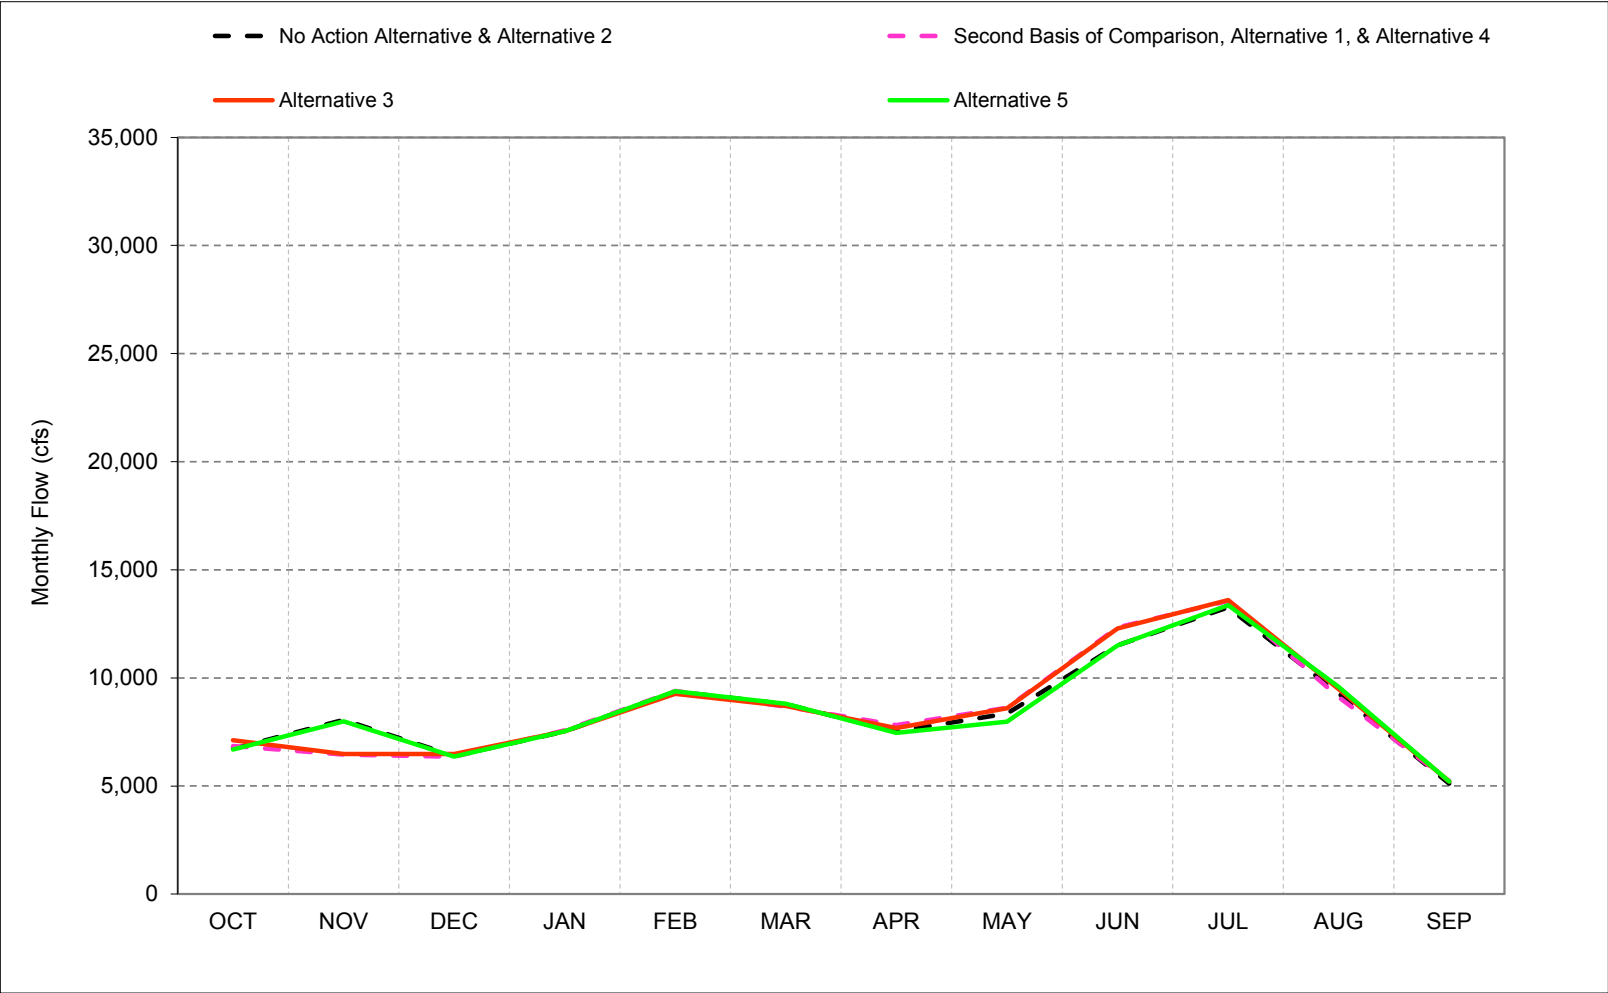


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-24-6. Sacramento River at Bend Bridge, Critical Year* Long-Term** Average Flow

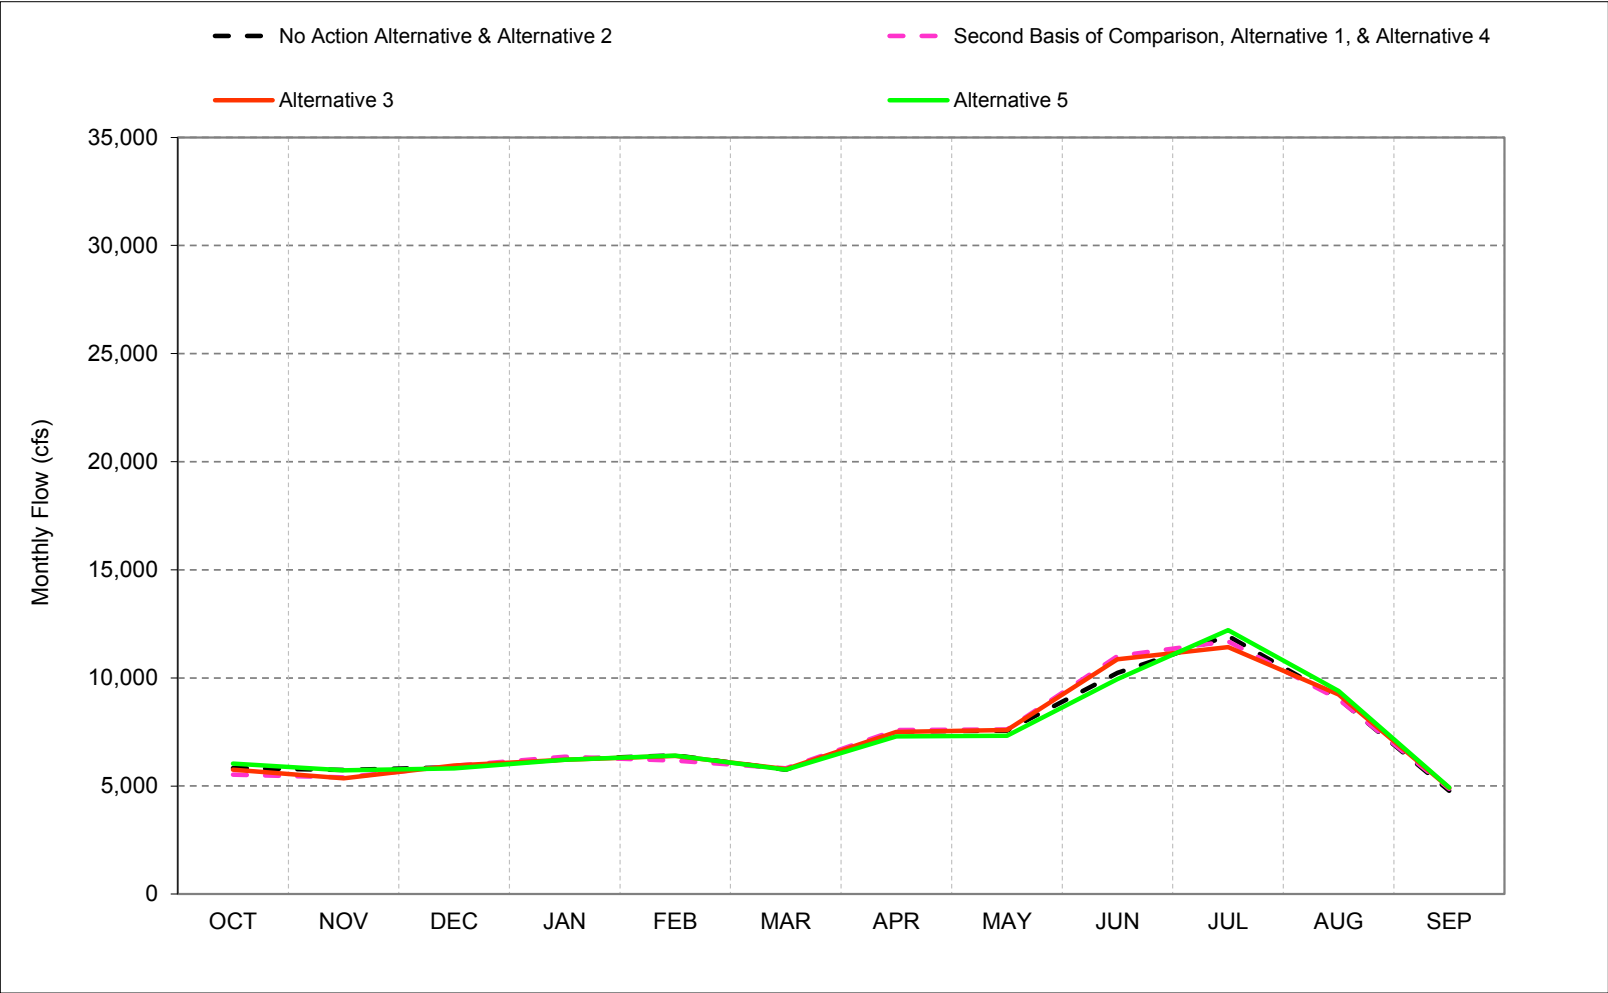

*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-24-1. Sacramento River at Bend Bridge, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	9,666	12,952	25,817	35,635	46,146	29,257	16,364	12,625	13,670	15,334	11,928	15,074
20%	8,705	12,051	16,957	23,582	31,477	19,298	12,989	10,628	12,322	15,096	11,025	12,855
30%	8,311	10,913	11,251	15,985	21,153	13,887	9,331	9,895	12,023	15,004	10,833	10,819
40%	7,595	10,007	8,517	11,441	12,917	10,373	8,599	9,317	11,432	14,799	10,430	9,267
50%	6,667	8,244	7,016	9,051	10,692	8,819	8,344	8,693	11,146	14,437	10,242	6,727
60%	6,367	7,281	6,534	7,486	8,639	7,841	7,824	8,246	10,849	13,548	9,732	5,623
70%	5,897	6,739	6,023	6,528	7,662	7,207	7,219	7,687	10,648	12,954	9,282	5,068
80%	5,567	5,663	5,334	5,902	6,520	5,947	6,917	7,374	10,107	12,203	8,933	4,647
90%	5,271	5,119	5,060	4,956	5,074	4,966	6,354	6,894	9,650	11,155	8,487	4,541
Long Term												
Full Simulation Period ^b	7,162	9,170	11,871	15,570	19,157	14,290	10,232	9,392	11,467	13,652	10,151	8,489
Water Year Types^c												
Wet (32%)	7,983	11,521	20,328	28,792	32,195	24,782	14,201	11,182	11,611	13,851	10,642	13,466
Above Normal (16%)	7,175	9,450	13,251	16,613	25,773	15,371	10,643	9,666	11,952	14,807	10,718	9,412
Below Normal (13%)	7,451	9,047	6,762	7,891	12,211	7,549	8,235	8,715	11,826	14,395	11,126	5,819
Dry (24%)	6,724	8,054	6,390	7,526	9,373	8,779	7,528	8,354	11,505	13,262	9,276	5,112
Critical (15%)	5,833	5,748	5,872	6,235	6,415	5,750	7,525	7,567	10,241	11,940	9,035	4,780

Alternative 1												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	9,210	11,246	30,228	37,208	47,106	29,294	16,401	12,695	14,989	15,329	12,928	9,537
20%	8,808	8,825	18,528	25,046	31,478	18,689	12,991	11,024	13,990	15,135	12,090	6,805
30%	8,518	7,602	11,795	16,326	22,727	14,977	9,942	10,267	12,778	14,969	11,260	6,468
40%	7,130	7,155	8,883	13,229	13,125	10,879	9,199	9,671	12,147	14,760	10,984	6,129
50%	6,545	6,725	7,032	9,590	10,802	8,958	8,529	9,034	11,715	14,420	10,409	5,846
60%	6,018	6,351	6,364	7,482	8,684	7,944	7,994	8,497	11,355	13,635	10,207	5,609
70%	5,634	5,821	5,840	6,526	7,561	7,207	7,475	8,070	11,099	13,202	9,502	5,157
80%	5,395	5,462	5,274	5,906	6,519	5,949	7,110	7,596	10,536	12,408	9,024	4,642
90%	4,882	4,940	4,878	4,979	5,147	5,080	6,586	7,102	10,064	11,119	8,382	4,526
Long Term												
Full Simulation Period ^b	6,974	7,830	12,476	16,171	19,478	14,539	10,390	9,657	12,139	13,686	10,606	6,279
Water Year Types^c												
Wet (32%)	7,555	9,871	22,382	29,625	32,396	24,855	14,217	11,299	11,760	13,714	11,404	7,783
Above Normal (16%)	7,009	8,103	12,892	17,688	27,292	16,180	10,714	10,030	12,864	14,893	11,513	6,508
Below Normal (13%)	7,368	7,826	6,836	8,912	12,557	8,405	8,681	9,459	13,033	14,597	12,101	5,898
Dry (24%)	6,848	6,461	6,360	7,577	9,392	8,666	7,821	8,617	12,341	13,561	9,116	5,227
Critical (15%)	5,523	5,398	5,929	6,357	6,178	5,823	7,592	7,607	11,018	11,691	9,009	4,874

Alternative 1 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-456	-1,706	4,411	1,573	961	37	37	70	1,319	-5	1,000	-5,537
20%	103	-3,226	1,571	1,464	0	-609	2	396	1,668	39	1,066	-6,050
30%	207	-3,311	544	341	1,574	1,090	611	372	754	-34	427	-4,351
40%	-465	-2,852	366	1,788	208	506	599	354	715	-39	553	-3,138
50%	-121	-1,519	16	539	109	139	186	341	569	-17	167	-881
60%	-350	-930	-170	-4	45	102	170	252	506	87	475	-14
70%	-264	-918	-182	-1	-101	0	257	383	451	248	220	89
80%	-172	-201	-60	4	-1	2	194	222	430	205	91	-5
90%	-389	-179	-182	22	73	113	232	208	413	-36	-105	-16
Long Term												
Full Simulation Period ^b	-188	-1,340	605	601	321	250	158	265	671	34	456	-2,210
Water Year Types^c												
Wet (32%)	-427	-1,650	2,054	832	201	73	17	118	149	-137	763	-5,682
Above Normal (16%)	-166	-1,347	-359	1,076	1,520	809	71	364	912	85	795	-2,904
Below Normal (13%)	-83	-1,221	74	1,020	347	856	446	744	1,207	202	975	79
Dry (24%)	124	-1,593	-31	50	20	-112	294	262	836	299	-160	114
Critical (15%)	-309	-350	57	122	-237	73	66	40	777	-250	-26	94

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-24-2. Sacramento River at Bend Bridge, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	9,666	12,952	25,817	35,635	46,146	29,257	16,364	12,625	13,670	15,334	11,928	15,074
20%	8,705	12,051	16,957	23,582	31,477	19,298	12,989	10,628	12,322	15,096	11,025	12,855
30%	8,311	10,913	11,251	15,985	21,153	13,887	9,331	9,895	12,023	15,004	10,833	10,819
40%	7,595	10,007	8,517	11,441	12,917	10,373	8,599	9,317	11,432	14,799	10,430	9,267
50%	6,667	8,244	7,016	9,051	10,692	8,819	8,344	8,693	11,146	14,437	10,242	6,727
60%	6,367	7,281	6,534	7,486	8,639	7,841	7,824	8,246	10,849	13,548	9,732	5,623
70%	5,897	6,739	6,023	6,528	7,662	7,207	7,219	7,687	10,648	12,954	9,282	5,068
80%	5,567	5,663	5,334	5,902	6,520	5,947	6,917	7,374	10,107	12,203	8,933	4,647
90%	5,271	5,119	5,060	4,956	5,074	4,966	6,354	6,894	9,650	11,155	8,487	4,541
Long Term												
Full Simulation Period ^b	7,162	9,170	11,871	15,570	19,157	14,290	10,232	9,392	11,467	13,652	10,151	8,489
Water Year Types^c												
Wet (32%)	7,983	11,521	20,328	28,792	32,195	24,782	14,201	11,182	11,611	13,851	10,642	13,466
Above Normal (16%)	7,175	9,450	13,251	16,613	25,773	15,371	10,643	9,666	11,952	14,807	10,718	9,412
Below Normal (13%)	7,451	9,047	6,762	7,891	12,211	7,549	8,235	8,715	11,826	14,395	11,126	5,819
Dry (24%)	6,724	8,054	6,390	7,526	9,373	8,779	7,528	8,354	11,505	13,262	9,276	5,112
Critical (15%)	5,833	5,748	5,872	6,235	6,415	5,750	7,525	7,567	10,241	11,940	9,035	4,780

Alternative 3												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	9,386	11,729	30,238	38,412	47,106	29,297	16,363	12,678	14,680	15,332	12,196	9,287
20%	8,822	8,548	19,566	25,043	31,476	18,693	12,990	10,993	13,862	15,171	11,609	8,174
30%	8,250	7,629	11,041	16,361	22,570	14,976	9,843	10,357	12,690	14,979	11,239	6,799
40%	7,642	7,085	8,883	12,757	12,818	10,771	9,030	9,720	12,023	14,799	10,753	6,356
50%	6,481	6,796	7,033	9,562	10,750	8,962	8,465	9,155	11,717	14,463	10,351	5,959
60%	6,047	6,280	6,540	7,482	8,683	7,944	7,957	8,529	11,338	13,601	10,114	5,491
70%	5,790	5,826	5,947	6,525	7,686	7,207	7,277	8,103	11,119	12,957	9,773	5,224
80%	5,423	5,462	5,360	5,903	6,587	5,951	6,964	7,646	10,568	12,254	9,075	4,828
90%	5,263	5,120	4,897	4,956	5,145	4,977	6,580	6,967	10,057	11,151	8,644	4,543
Long Term												
Full Simulation Period ^b	7,074	7,769	12,509	16,120	19,474	14,561	10,327	9,658	12,070	13,667	10,462	6,529
Water Year Types^c												
Wet (32%)	7,512	9,763	22,373	29,702	32,436	24,855	14,223	11,307	11,877	13,801	11,107	7,992
Above Normal (16%)	7,153	8,152	12,917	17,436	27,179	16,303	10,662	10,086	12,635	14,830	11,050	6,478
Below Normal (13%)	7,291	7,570	6,819	8,887	12,545	8,390	8,603	9,424	12,780	14,543	11,365	7,301
Dry (24%)	7,120	6,483	6,487	7,525	9,270	8,705	7,686	8,605	12,290	13,602	9,481	5,203
Critical (15%)	5,763	5,362	5,948	6,220	6,399	5,788	7,505	7,592	10,857	11,426	9,234	4,914

Alternative 3 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-280	-1,223	4,420	2,777	961	40	-1	53	1,010	-2	268	-5,786
20%	117	-3,503	2,609	1,461	-1	-605	2	365	1,540	75	585	-4,681
30%	-61	-3,284	-210	377	1,417	1,088	512	462	667	-24	406	-4,020
40%	47	-2,922	366	1,316	-99	397	430	403	591	1	322	-2,911
50%	-186	-1,448	17	511	58	143	122	462	571	26	109	-768
60%	-320	-1,001	7	-3	44	103	133	283	488	53	382	-132
70%	-108	-913	-76	-3	24	0	58	416	471	3	491	156
80%	-144	-201	26	1	67	3	47	272	462	52	142	181
90%	-8	2	-162	0	71	11	226	73	406	-4	158	2
Long Term												
Full Simulation Period ^b	-88	-1,401	638	550	317	271	95	266	602	15	311	-1,960
Water Year Types^c												
Wet (32%)	-471	-1,758	2,044	910	241	73	22	125	266	-50	465	-5,474
Above Normal (16%)	-21	-1,297	-333	823	1,406	932	19	420	683	23	332	-2,934
Below Normal (13%)	-160	-1,477	57	995	334	840	367	709	954	149	239	1,482
Dry (24%)	396	-1,571	96	-1	-103	-73	158	250	785	340	204	90
Critical (15%)	-70	-386	76	-15	-16	38	-20	25	616	-514	199	134

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-24-3. Sacramento River at Bend Bridge, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	9,666	12,952	25,817	35,635	46,146	29,257	16,364	12,625	13,670	15,334	11,928	15,074
20%	8,705	12,051	16,957	23,582	31,477	19,298	12,989	10,628	12,322	15,096	11,025	12,855
30%	8,311	10,913	11,251	15,985	21,153	13,887	9,331	9,895	12,023	15,004	10,833	10,819
40%	7,595	10,007	8,517	11,441	12,917	10,373	8,599	9,317	11,432	14,799	10,430	9,267
50%	6,667	8,244	7,016	9,051	10,692	8,819	8,344	8,693	11,146	14,437	10,242	6,727
60%	6,367	7,281	6,534	7,486	8,639	7,841	7,824	8,246	10,849	13,548	9,732	5,623
70%	5,897	6,739	6,023	6,528	7,662	7,207	7,219	7,687	10,648	12,954	9,282	5,068
80%	5,567	5,663	5,334	5,902	6,520	5,947	6,917	7,374	10,107	12,203	8,933	4,647
90%	5,271	5,119	5,060	4,956	5,074	4,966	6,354	6,894	9,650	11,155	8,487	4,541
Long Term												
Full Simulation Period ^b	7,162	9,170	11,871	15,570	19,157	14,290	10,232	9,392	11,467	13,652	10,151	8,489
Water Year Types ^c												
Wet (32%)	7,983	11,521	20,328	28,792	32,195	24,782	14,201	11,182	11,611	13,851	10,642	13,466
Above Normal (16%)	7,175	9,450	13,251	16,613	25,773	15,371	10,643	9,666	11,952	14,807	10,718	9,412
Below Normal (13%)	7,451	9,047	6,762	7,891	12,211	7,549	8,235	8,715	11,826	14,395	11,126	5,819
Dry (24%)	6,724	8,054	6,390	7,526	9,373	8,779	7,528	8,354	11,505	13,262	9,276	5,112
Critical (15%)	5,833	5,748	5,872	6,235	6,415	5,750	7,525	7,567	10,241	11,940	9,035	4,780

Alternative 5												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	9,789	12,949	24,963	35,641	46,144	29,257	16,362	12,591	13,596	15,332	11,804	15,055
20%	8,691	12,012	16,908	23,582	31,478	19,315	12,989	10,466	12,322	15,055	11,114	12,857
30%	8,252	10,947	11,254	16,024	21,199	13,888	9,226	9,619	11,944	14,998	10,911	10,789
40%	7,661	10,173	8,517	11,441	13,003	10,373	8,599	9,122	11,370	14,799	10,628	9,087
50%	6,707	8,257	7,029	9,051	10,692	8,819	8,223	8,549	11,111	14,479	10,289	6,638
60%	6,317	7,328	6,463	7,486	8,626	7,901	7,672	8,111	10,850	13,795	9,962	5,726
70%	5,926	6,741	5,964	6,528	7,662	7,207	7,203	7,641	10,528	12,962	9,498	5,306
80%	5,589	5,403	5,333	5,966	6,520	5,947	6,917	7,371	10,102	12,211	8,998	4,896
90%	5,372	4,947	4,951	4,959	5,074	4,966	6,519	6,860	9,601	11,095	8,442	4,609
Long Term												
Full Simulation Period ^b	7,177	9,168	11,841	15,578	19,164	14,308	10,188	9,245	11,413	13,730	10,245	8,532
Water Year Types ^c												
Wet (32%)	7,916	11,637	20,268	28,790	32,209	24,797	14,201	11,185	11,601	13,886	10,652	13,435
Above Normal (16%)	7,275	9,317	13,289	16,649	25,711	15,396	10,643	9,588	11,926	14,830	10,675	9,313
Below Normal (13%)	7,434	9,037	6,733	7,928	12,293	7,578	8,281	8,663	11,793	14,391	10,905	5,999
Dry (24%)	6,692	7,996	6,366	7,527	9,380	8,800	7,457	7,977	11,505	13,362	9,588	5,204
Critical (15%)	6,040	5,731	5,820	6,222	6,414	5,753	7,301	7,318	9,947	12,204	9,390	4,933

Alternative 5 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	123	-2	-855	6	-1	0	-2	-34	-74	-2	-124	-19
20%	-14	-40	-49	0	1	17	1	-162	0	-41	89	2
30%	-59	34	3	39	45	1	-104	-277	-79	-5	78	-30
40%	67	166	0	0	87	0	0	-195	-61	1	198	-181
50%	41	14	13	0	0	1	-121	-143	-35	42	46	-88
60%	-50	47	-71	1	-13	60	-152	-135	1	247	230	104
70%	28	2	-59	0	0	0	-15	-46	-120	8	216	237
80%	22	-259	-1	64	0	0	0	-2	-4	8	65	249
90%	101	-172	-108	3	0	0	165	-34	-50	-59	-45	68
Long Term												
Full Simulation Period ^b	15	-2	-30	8	7	18	-44	-147	-55	77	95	44
Water Year Types ^c												
Wet (32%)	-66	116	-60	-2	14	15	0	3	-10	35	10	-31
Above Normal (16%)	100	-132	38	36	-62	25	-1	-78	-26	23	-43	-99
Below Normal (13%)	-17	-10	-29	36	82	29	45	-52	-33	-3	-221	180
Dry (24%)	-32	-58	-24	0	7	21	-70	-377	-1	101	311	92
Critical (15%)	207	-17	-52	-13	-2	3	-225	-249	-293	264	355	153

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-24-4. Sacramento River at Bend Bridge, Monthly Flow

Second Basis of Comparison		Monthly Flow (cfs)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	9,210	11,246	30,228	37,208	47,106	29,294	16,401	12,695	14,989	15,329	12,928	9,537
20%	8,808	8,825	18,528	25,046	31,478	18,689	12,991	11,024	13,990	15,135	12,090	6,805
30%	8,518	7,602	11,795	16,326	22,727	14,977	9,942	10,267	12,778	14,969	11,260	6,468
40%	7,130	7,155	8,883	13,229	13,125	10,879	9,199	9,671	12,147	14,760	10,984	6,129
50%	6,545	6,725	7,032	9,590	10,802	8,958	8,529	9,034	11,715	14,420	10,409	5,846
60%	6,018	6,351	6,364	7,482	8,684	7,944	7,994	8,497	11,355	13,635	10,207	5,609
70%	5,634	5,821	5,840	6,526	7,561	7,207	7,475	8,070	11,099	13,202	9,502	5,157
80%	5,395	5,462	5,274	5,906	6,519	5,949	7,110	7,596	10,536	12,408	9,024	4,642
90%	4,882	4,940	4,878	4,979	5,147	5,080	6,586	7,102	10,064	11,119	8,382	4,526
Long Term												
Full Simulation Period ^b	6,974	7,830	12,476	16,171	19,478	14,539	10,390	9,657	12,139	13,686	10,606	6,279
Water Year Types^c												
Wet (32%)	7,555	9,871	22,382	29,625	32,396	24,855	14,217	11,299	11,760	13,714	11,404	7,783
Above Normal (16%)	7,009	8,103	12,892	17,688	27,292	16,180	10,714	10,030	12,864	14,893	11,513	6,508
Below Normal (13%)	7,368	7,826	6,836	8,912	12,557	8,405	8,681	9,459	13,033	14,597	12,101	5,898
Dry (24%)	6,848	6,461	6,360	7,577	9,392	8,666	7,821	8,617	12,341	13,561	9,116	5,227
Critical (15%)	5,523	5,398	5,929	6,357	6,178	5,823	7,592	7,607	11,018	11,691	9,009	4,874

No Action Alternative		Monthly Flow (cfs)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	9,666	12,952	25,817	35,635	46,146	29,257	16,364	12,625	13,670	15,334	11,928	15,074
20%	8,705	12,051	16,957	23,582	31,477	19,298	12,989	10,628	12,322	15,096	11,025	12,855
30%	8,311	10,913	11,251	15,985	21,153	13,887	9,331	9,895	12,023	15,004	10,833	10,819
40%	7,595	10,007	8,517	11,441	12,917	10,373	8,599	9,317	11,432	14,799	10,430	9,267
50%	6,667	8,244	7,016	9,051	10,692	8,819	8,344	8,693	11,146	14,437	10,242	6,727
60%	6,367	7,281	6,534	7,486	8,639	7,841	7,824	8,246	10,849	13,548	9,732	5,623
70%	5,897	6,739	6,023	6,528	7,662	7,207	7,219	7,687	10,648	12,954	9,282	5,068
80%	5,567	5,663	5,334	5,902	6,520	5,947	6,917	7,374	10,107	12,203	8,933	4,647
90%	5,271	5,119	5,060	4,956	5,074	4,966	6,354	6,894	9,650	11,155	8,487	4,541
Long Term												
Full Simulation Period ^b	7,162	9,170	11,871	15,570	19,157	14,290	10,232	9,392	11,467	13,652	10,151	8,489
Water Year Types^c												
Wet (32%)	7,983	11,521	20,328	28,792	32,195	24,782	14,201	11,182	11,611	13,851	10,642	13,466
Above Normal (16%)	7,175	9,450	13,251	16,613	25,773	15,371	10,643	9,666	11,952	14,807	10,718	9,412
Below Normal (13%)	7,451	9,047	6,762	7,891	12,211	7,549	8,235	8,715	11,826	14,395	11,126	5,819
Dry (24%)	6,724	8,054	6,390	7,526	9,373	8,779	7,528	8,354	11,505	13,262	9,276	5,112
Critical (15%)	5,833	5,748	5,872	6,235	6,415	5,750	7,525	7,567	10,241	11,940	9,035	4,780

No Action Alternative minus Second Basis of Comparison		Monthly Flow (cfs)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	456	1,706	-4,411	-1,573	-961	-37	-37	-70	-1,319	5	-1,000	5,537
20%	-103	3,226	-1,571	-1,464	0	609	-2	-396	-1,668	-39	-1,066	6,050
30%	-207	3,311	-544	-341	-1,574	-1,090	-611	-372	-754	34	-427	4,351
40%	465	2,852	-366	-1,788	-208	-506	-599	-354	-715	39	-553	3,138
50%	121	1,519	-16	-539	-109	-139	-186	-341	-569	17	-167	881
60%	350	930	170	4	-45	-102	-170	-252	-506	-87	-475	14
70%	264	918	182	1	101	0	-257	-383	-451	-248	-220	-89
80%	172	201	60	-4	1	-2	-194	-222	-430	-205	-91	5
90%	389	179	182	-22	-73	-113	-232	-208	-413	36	105	16
Long Term												
Full Simulation Period ^b	188	1,340	-605	-601	-321	-250	-158	-265	-671	-34	-456	2,210
Water Year Types^c												
Wet (32%)	427	1,650	-2,054	-832	-201	-73	-17	-118	-149	137	-763	5,682
Above Normal (16%)	166	1,347	359	-1,076	-1,520	-809	-71	-364	-912	-85	-795	2,904
Below Normal (13%)	83	1,221	-74	-1,020	-347	-856	-446	-744	-1,207	-202	-975	-79
Dry (24%)	-124	1,593	31	-50	-20	112	-294	-262	-836	-299	160	-114
Critical (15%)	309	350	-57	-122	237	-73	-66	-40	-777	250	26	-94

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-24-5. Sacramento River at Bend Bridge, Monthly Flow

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	9,210	11,246	30,228	37,208	47,106	29,294	16,401	12,695	14,989	15,329	12,928	9,537
20%	8,808	8,825	18,528	25,046	31,478	18,689	12,991	11,024	13,990	15,135	12,090	6,805
30%	8,518	7,602	11,795	16,326	22,727	14,977	9,942	10,267	12,778	14,969	11,260	6,468
40%	7,130	7,155	8,883	13,229	13,125	10,879	9,199	9,671	12,147	14,760	10,984	6,129
50%	6,545	6,725	7,032	9,590	10,802	8,958	8,529	9,034	11,715	14,420	10,409	5,846
60%	6,018	6,351	6,364	7,482	8,684	7,944	7,994	8,497	11,355	13,635	10,207	5,609
70%	5,634	5,821	5,840	6,526	7,561	7,207	7,475	8,070	11,099	13,202	9,502	5,157
80%	5,395	5,462	5,274	5,906	6,519	5,949	7,110	7,596	10,536	12,408	9,024	4,642
90%	4,882	4,940	4,878	4,979	5,147	5,080	6,586	7,102	10,064	11,119	8,382	4,526
Long Term												
Full Simulation Period ^b	6,974	7,830	12,476	16,171	19,478	14,539	10,390	9,657	12,139	13,686	10,606	6,279
Water Year Types ^c												
Wet (32%)	7,555	9,871	22,382	29,625	32,396	24,855	14,217	11,299	11,760	13,714	11,404	7,783
Above Normal (16%)	7,009	8,103	12,892	17,688	27,292	16,180	10,714	10,030	12,864	14,893	11,513	6,508
Below Normal (13%)	7,368	7,826	6,836	8,912	12,557	8,405	8,681	9,459	13,033	14,597	12,101	5,898
Dry (24%)	6,848	6,461	6,360	7,577	9,392	8,666	7,821	8,617	12,341	13,561	9,116	5,227
Critical (15%)	5,523	5,398	5,929	6,357	6,178	5,823	7,592	7,607	11,018	11,691	9,009	4,874

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 3												
Probability of Exceedance ^a												
10%	9,386	11,729	30,238	38,412	47,106	29,297	16,363	12,678	14,680	15,332	12,196	9,287
20%	8,822	8,548	19,566	25,043	31,476	18,693	12,990	10,993	13,862	15,171	11,609	8,174
30%	8,250	7,629	11,041	16,361	22,570	14,976	9,843	10,357	12,690	14,979	11,239	6,799
40%	7,642	7,085	8,883	12,757	12,818	10,771	9,030	9,720	12,023	14,799	10,753	6,356
50%	6,481	6,796	7,033	9,562	10,750	8,962	8,465	9,155	11,717	14,463	10,351	5,959
60%	6,047	6,280	6,540	7,482	8,683	7,944	7,957	8,529	11,338	13,601	10,114	5,491
70%	5,790	5,826	5,947	6,525	7,686	7,207	7,277	8,103	11,119	12,957	9,773	5,224
80%	5,423	5,462	5,360	5,903	6,587	5,951	6,964	7,646	10,568	12,254	9,075	4,828
90%	5,263	5,120	4,897	4,956	5,145	4,977	6,580	6,967	10,057	11,151	8,644	4,543
Long Term												
Full Simulation Period ^b	7,074	7,769	12,509	16,120	19,474	14,561	10,327	9,658	12,070	13,667	10,462	6,529
Water Year Types ^c												
Wet (32%)	7,512	9,763	22,373	29,702	32,436	24,855	14,223	11,307	11,877	13,801	11,107	7,992
Above Normal (16%)	7,153	8,152	12,917	17,436	27,179	16,303	10,662	10,086	12,635	14,830	11,050	6,478
Below Normal (13%)	7,291	7,570	6,819	8,887	12,545	8,390	8,603	9,424	12,780	14,543	11,365	7,301
Dry (24%)	7,120	6,483	6,487	7,525	9,270	8,705	7,686	8,605	12,290	13,602	9,481	5,203
Critical (15%)	5,763	5,362	5,948	6,220	6,399	5,788	7,505	7,592	10,857	11,426	9,234	4,914

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 3 minus Second Basis of Comparison												
Probability of Exceedance ^a												
10%	176	483	10	1,204	0	4	-38	-17	-309	3	-732	-249
20%	14	-277	1,038	-3	-2	4	-1	-31	-129	36	-481	1,369
30%	-268	28	-754	36	-157	-1	-99	90	-87	10	-21	331
40%	512	-71	0	-472	-307	-109	-169	49	-125	39	-231	227
50%	-64	71	1	-27	-51	4	-64	121	2	43	-58	113
60%	29	-71	177	1	-1	0	-36	32	-18	-34	-93	-118
70%	156	5	106	-2	124	0	-198	33	20	-245	271	67
80%	28	0	87	-3	67	2	-146	50	32	-153	51	186
90%	380	180	20	-22	-2	-103	-6	-135	-7	32	262	17
Long Term												
Full Simulation Period ^b	100	-61	33	-52	-5	22	-63	1	-69	-18	-145	250
Water Year Types ^c												
Wet (32%)	-44	-108	-10	77	40	0	5	8	117	87	-297	209
Above Normal (16%)	145	50	25	-252	-113	124	-52	56	-228	-63	-463	-30
Below Normal (13%)	-77	-256	-17	-25	-13	-16	-79	-36	-253	-54	-736	1,403
Dry (24%)	272	22	127	-52	-123	39	-136	-12	-50	41	364	-24
Critical (15%)	240	-35	19	-137	221	-35	-87	-15	-161	-265	225	41

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-24-6. Sacramento River at Bend Bridge, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	9,210	11,246	30,228	37,208	47,106	29,294	16,401	12,695	14,989	15,329	12,928	9,537
20%	8,808	8,825	18,528	25,046	31,478	18,689	12,991	11,024	13,990	15,135	12,090	6,805
30%	8,518	7,602	11,795	16,326	22,727	14,977	9,942	10,267	12,778	14,969	11,260	6,468
40%	7,130	7,155	8,883	13,229	13,125	10,879	9,199	9,671	12,147	14,760	10,984	6,129
50%	6,545	6,725	7,032	9,590	10,802	8,958	8,529	9,034	11,715	14,420	10,409	5,846
60%	6,018	6,351	6,364	7,482	8,684	7,944	7,994	8,497	11,355	13,635	10,207	5,609
70%	5,634	5,821	5,840	6,526	7,561	7,207	7,475	8,070	11,099	13,202	9,502	5,157
80%	5,395	5,462	5,274	5,906	6,519	5,949	7,110	7,596	10,536	12,408	9,024	4,642
90%	4,882	4,940	4,878	4,979	5,147	5,080	6,586	7,102	10,064	11,119	8,382	4,526
Long Term												
Full Simulation Period ^b	6,974	7,830	12,476	16,171	19,478	14,539	10,390	9,657	12,139	13,686	10,606	6,279
Water Year Types ^c												
Wet (32%)	7,555	9,871	22,382	29,625	32,396	24,855	14,217	11,299	11,760	13,714	11,404	7,783
Above Normal (16%)	7,009	8,103	12,892	17,688	27,292	16,180	10,714	10,030	12,864	14,893	11,513	6,508
Below Normal (13%)	7,368	7,826	6,836	8,912	12,557	8,405	8,681	9,459	13,033	14,597	12,101	5,898
Dry (24%)	6,848	6,461	6,360	7,577	9,392	8,666	7,821	8,617	12,341	13,561	9,116	5,227
Critical (15%)	5,523	5,398	5,929	6,357	6,178	5,823	7,592	7,607	11,018	11,691	9,009	4,874

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	9,789	12,949	24,963	35,641	46,144	29,257	16,362	12,591	13,596	15,332	11,804	15,055
20%	8,691	12,012	16,908	23,582	31,478	19,315	12,989	10,466	12,322	15,055	11,114	12,857
30%	8,252	10,947	11,254	16,024	21,199	13,888	9,226	9,619	11,944	14,998	10,911	10,789
40%	7,661	10,173	8,517	11,441	13,003	10,373	8,599	9,122	11,370	14,799	10,628	9,087
50%	6,707	8,257	7,029	9,051	10,692	8,819	8,223	8,549	11,111	14,479	10,289	6,638
60%	6,317	7,328	6,463	7,486	8,626	7,901	7,672	8,111	10,850	13,795	9,962	5,726
70%	5,926	6,741	5,964	6,528	7,662	7,207	7,203	7,641	10,528	12,962	9,498	5,306
80%	5,589	5,403	5,333	5,966	6,520	5,947	6,917	7,371	10,102	12,211	8,998	4,896
90%	5,372	4,947	4,951	4,959	5,074	4,966	6,519	6,860	9,601	11,095	8,442	4,609
Long Term												
Full Simulation Period ^b	7,177	9,168	11,841	15,578	19,164	14,308	10,188	9,245	11,413	13,730	10,245	8,532
Water Year Types ^c												
Wet (32%)	7,916	11,637	20,268	28,790	32,209	24,797	14,201	11,185	11,601	13,886	10,652	13,435
Above Normal (16%)	7,275	9,317	13,289	16,649	25,711	15,396	10,643	9,588	11,926	14,830	10,675	9,313
Below Normal (13%)	7,434	9,037	6,733	7,928	12,293	7,578	8,281	8,663	11,793	14,391	10,905	5,999
Dry (24%)	6,692	7,996	6,366	7,527	9,380	8,800	7,457	7,977	11,505	13,362	9,588	5,204
Critical (15%)	6,040	5,731	5,820	6,222	6,414	5,753	7,301	7,318	9,947	12,204	9,390	4,933

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	579	1,703	-5,266	-1,567	-962	-37	-39	-104	-1,393	3	-1,124	5,519
20%	-117	3,187	-1,620	-1,465	0	626	-2	-557	-1,668	-80	-976	6,052
30%	-266	3,345	-541	-301	-1,528	-1,089	-715	-649	-833	29	-349	4,321
40%	532	3,018	-366	-1,788	-121	-506	-600	-549	-777	39	-355	2,958
50%	162	1,533	-3	-539	-109	-139	-306	-484	-604	59	-120	792
60%	299	977	99	5	-58	-42	-322	-386	-505	160	-246	118
70%	292	920	123	1	100	0	-272	-429	-571	-240	-4	148
80%	194	-59	59	60	1	-2	-194	-225	-434	-197	-26	254
90%	490	7	74	-20	-72	-114	-66	-242	-463	-23	60	83
Long Term												
Full Simulation Period ^b	203	1,338	-635	-593	-314	-232	-202	-411	-726	44	-361	2,254
Water Year Types ^c												
Wet (32%)	361	1,766	-2,114	-835	-187	-59	-16	-114	-159	172	-753	5,652
Above Normal (16%)	266	1,215	397	-1,039	-1,582	-784	-71	-442	-937	-62	-838	2,805
Below Normal (13%)	66	1,211	-103	-984	-265	-827	-401	-797	-1,240	-206	-1,196	101
Dry (24%)	-156	1,535	6	-50	-12	134	-364	-640	-836	-198	471	-22
Critical (15%)	517	333	-108	-135	236	-71	-291	-290	-1,071	513	381	60

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1 **C.25. Feather River Flow downstream of Thermalito**


Figure C-25-1. Feather River d/s of Thermalito, Long-Term* Average Flow

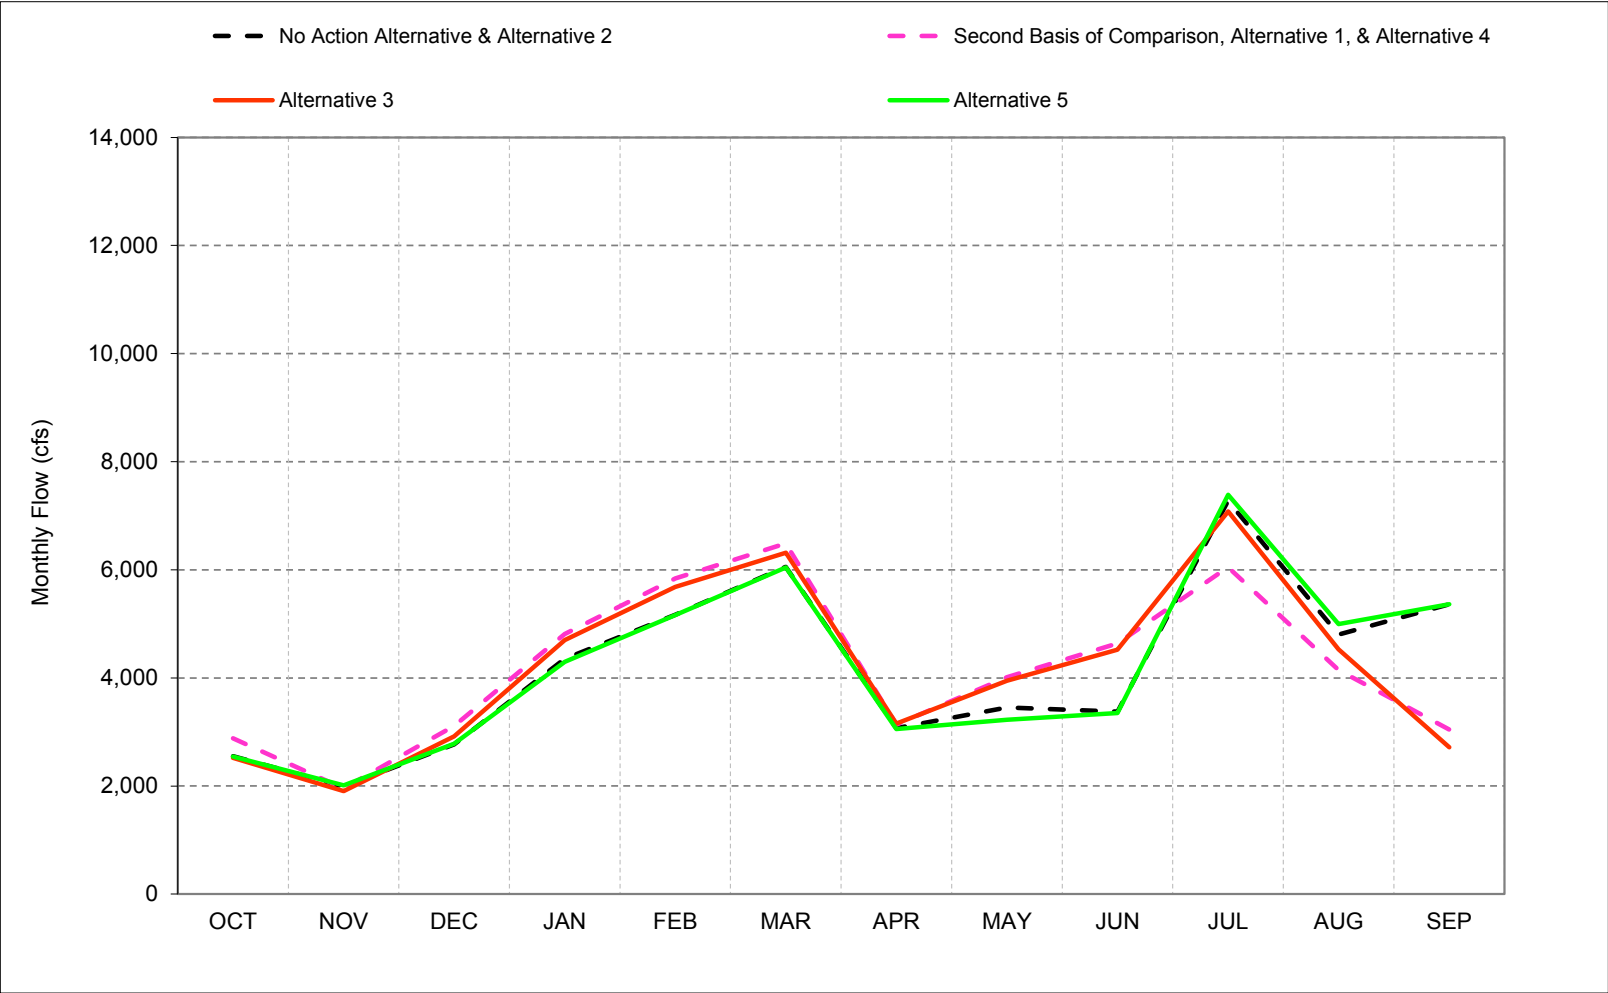

*Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-25-2. Feather River d/s of Thermalito, Wet Year* Long-Term** Average Flow

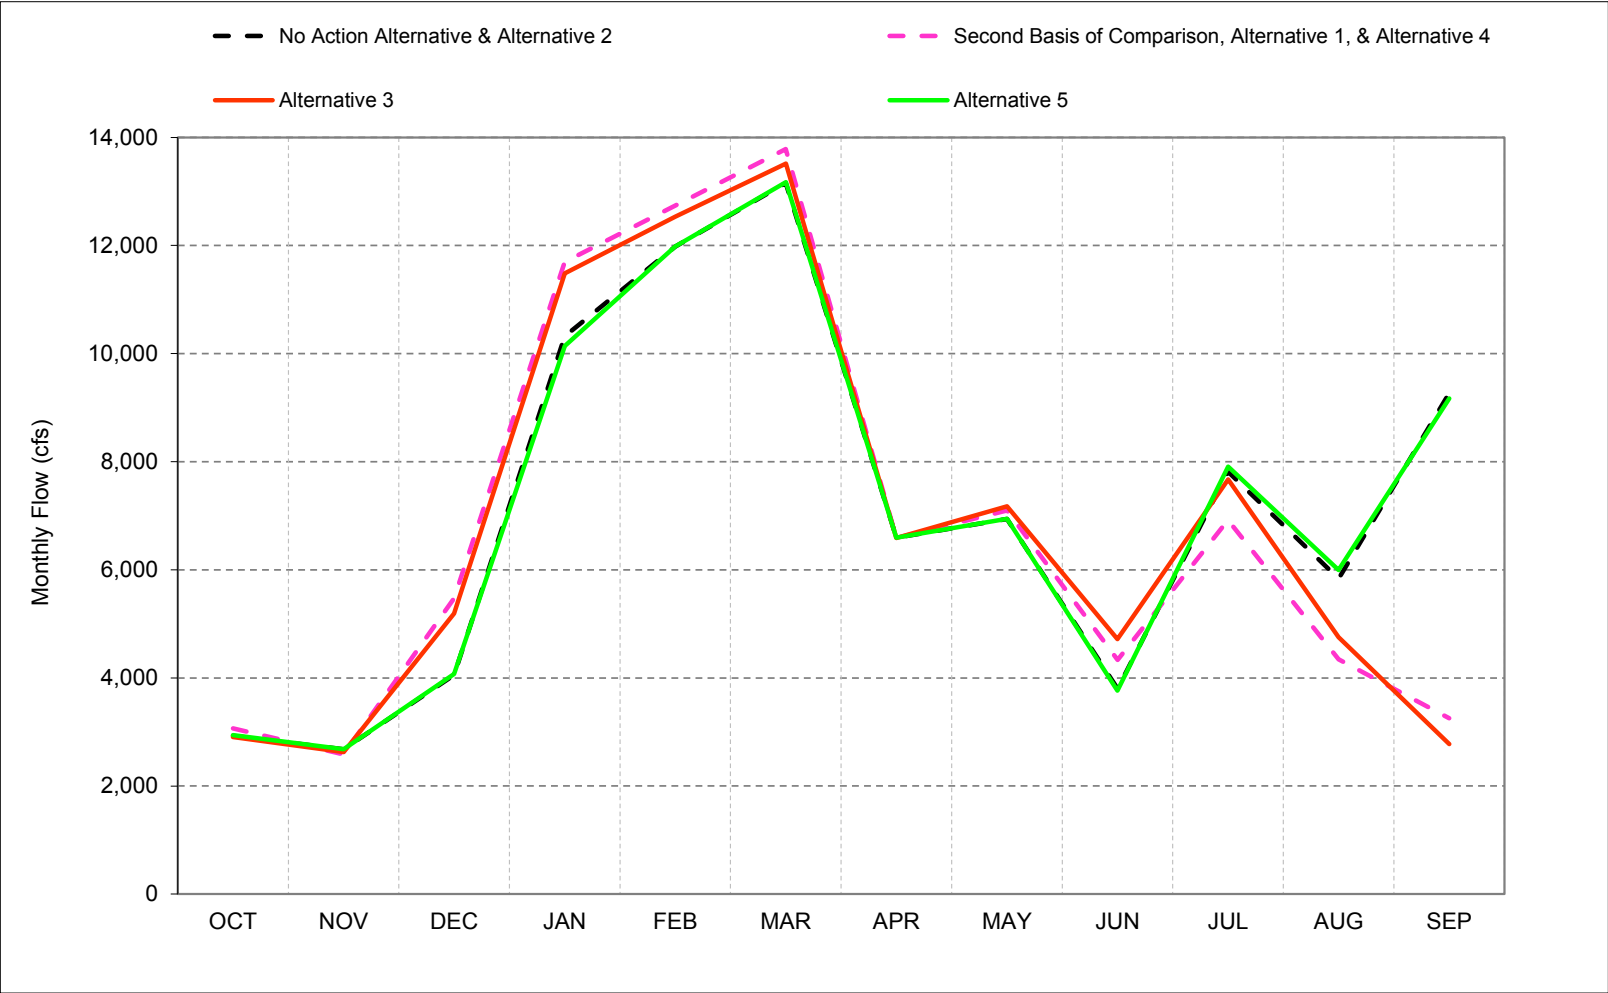


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-25-3. Feather River d/s of Thermalito, Above Normal Year* Long-Term** Average Flow

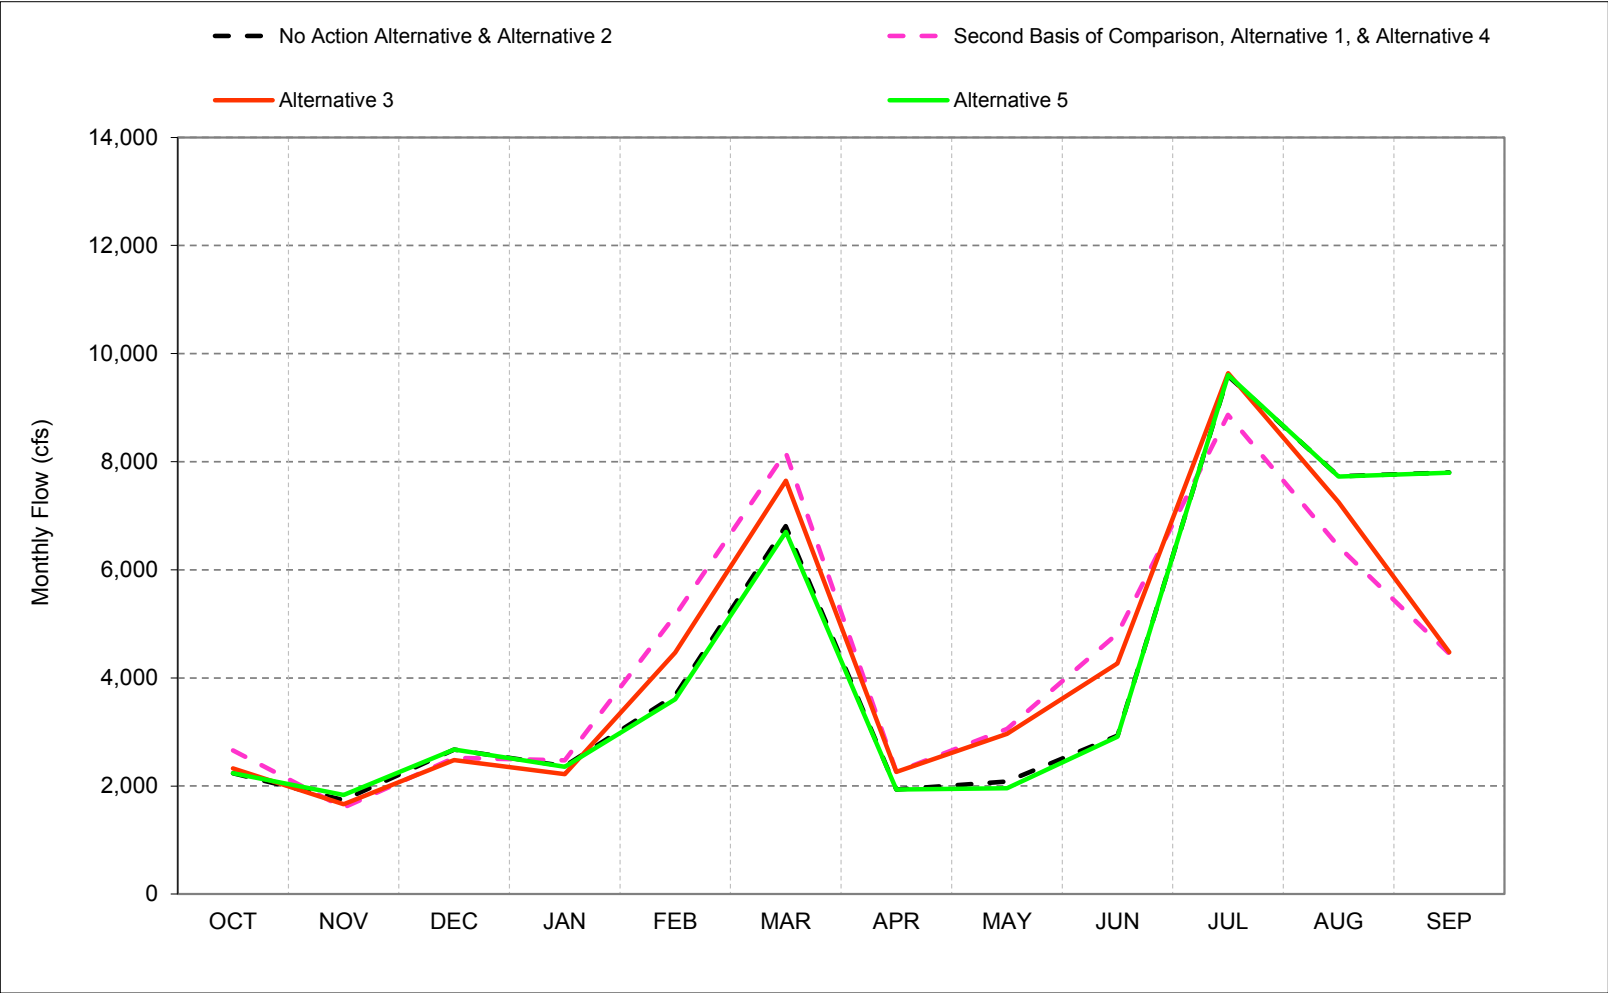


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-25-4. Feather River d/s of Thermalito, Below Normal Year* Long-Term** Average Flow

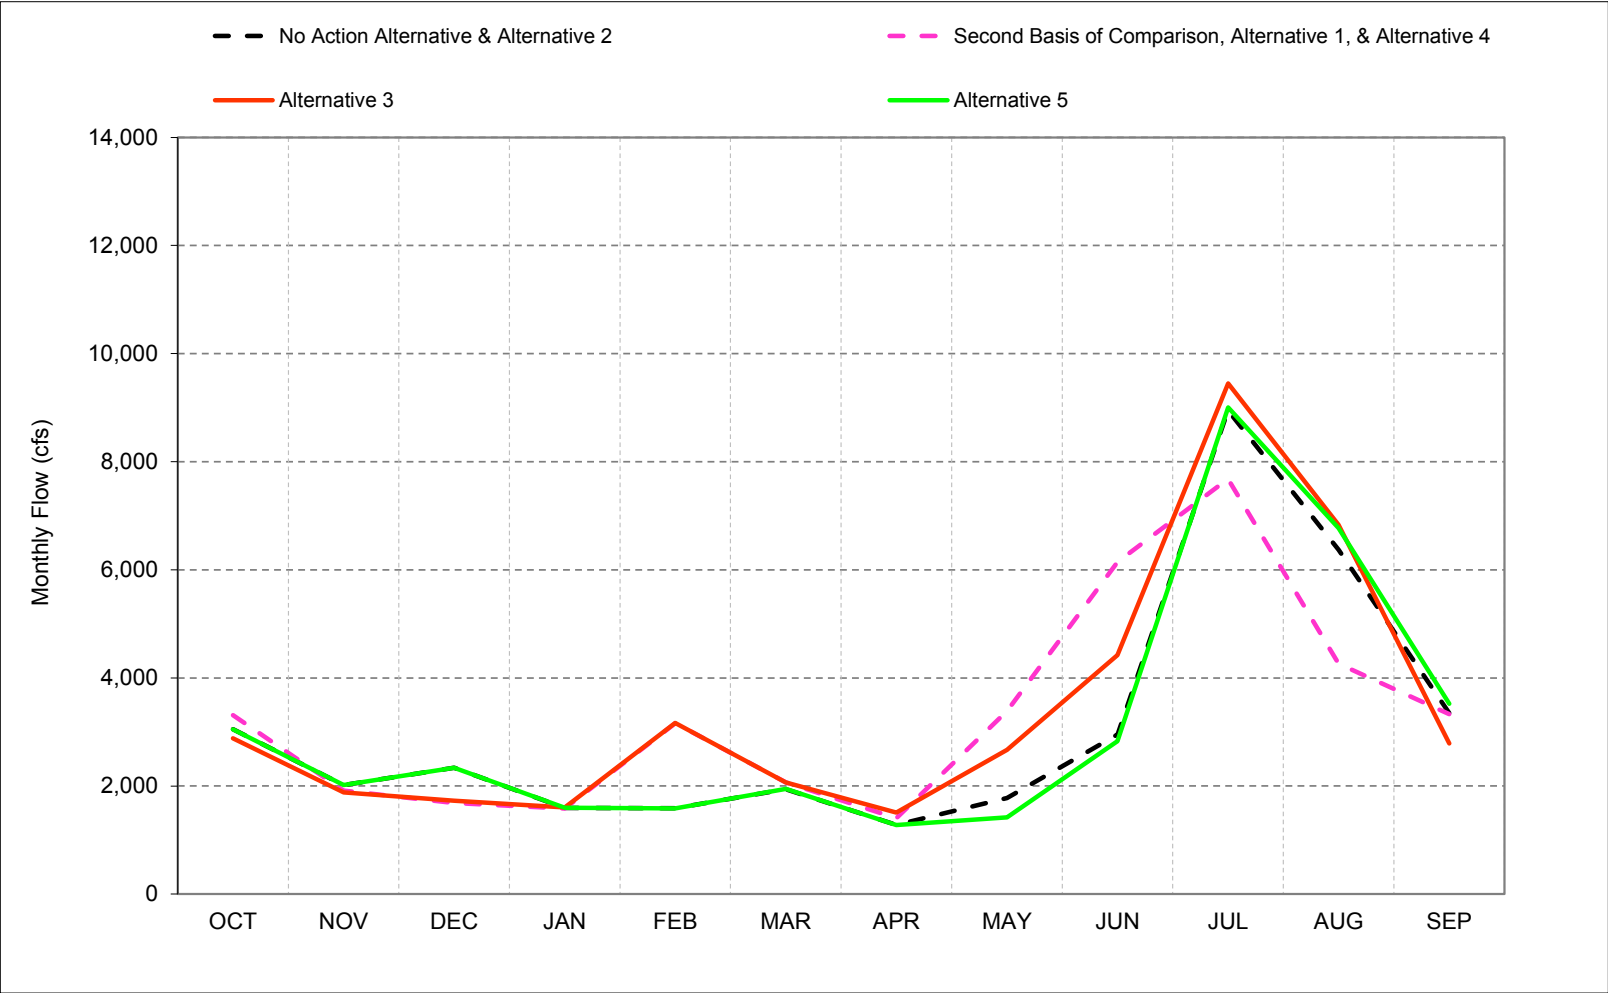


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-25-5. Feather River d/s of Thermalito, Dry Year* Long-Term** Average Flow

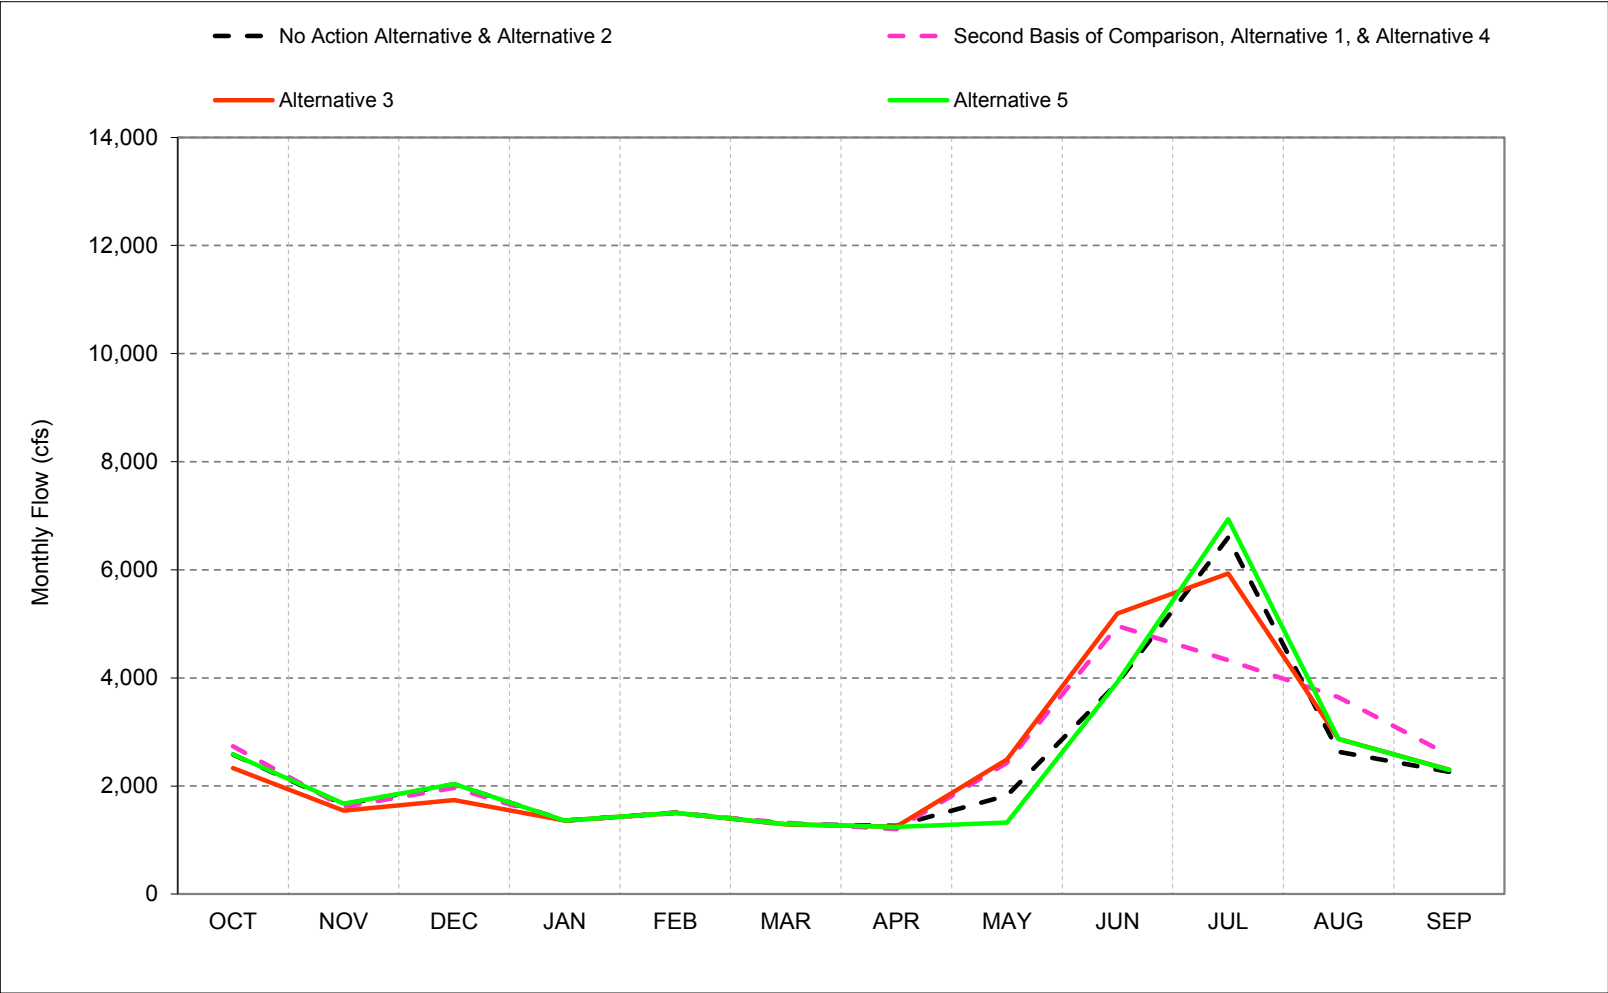


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-25-6. Feather River d/s of Thermalito, Critical Year* Long-Term** Average Flow

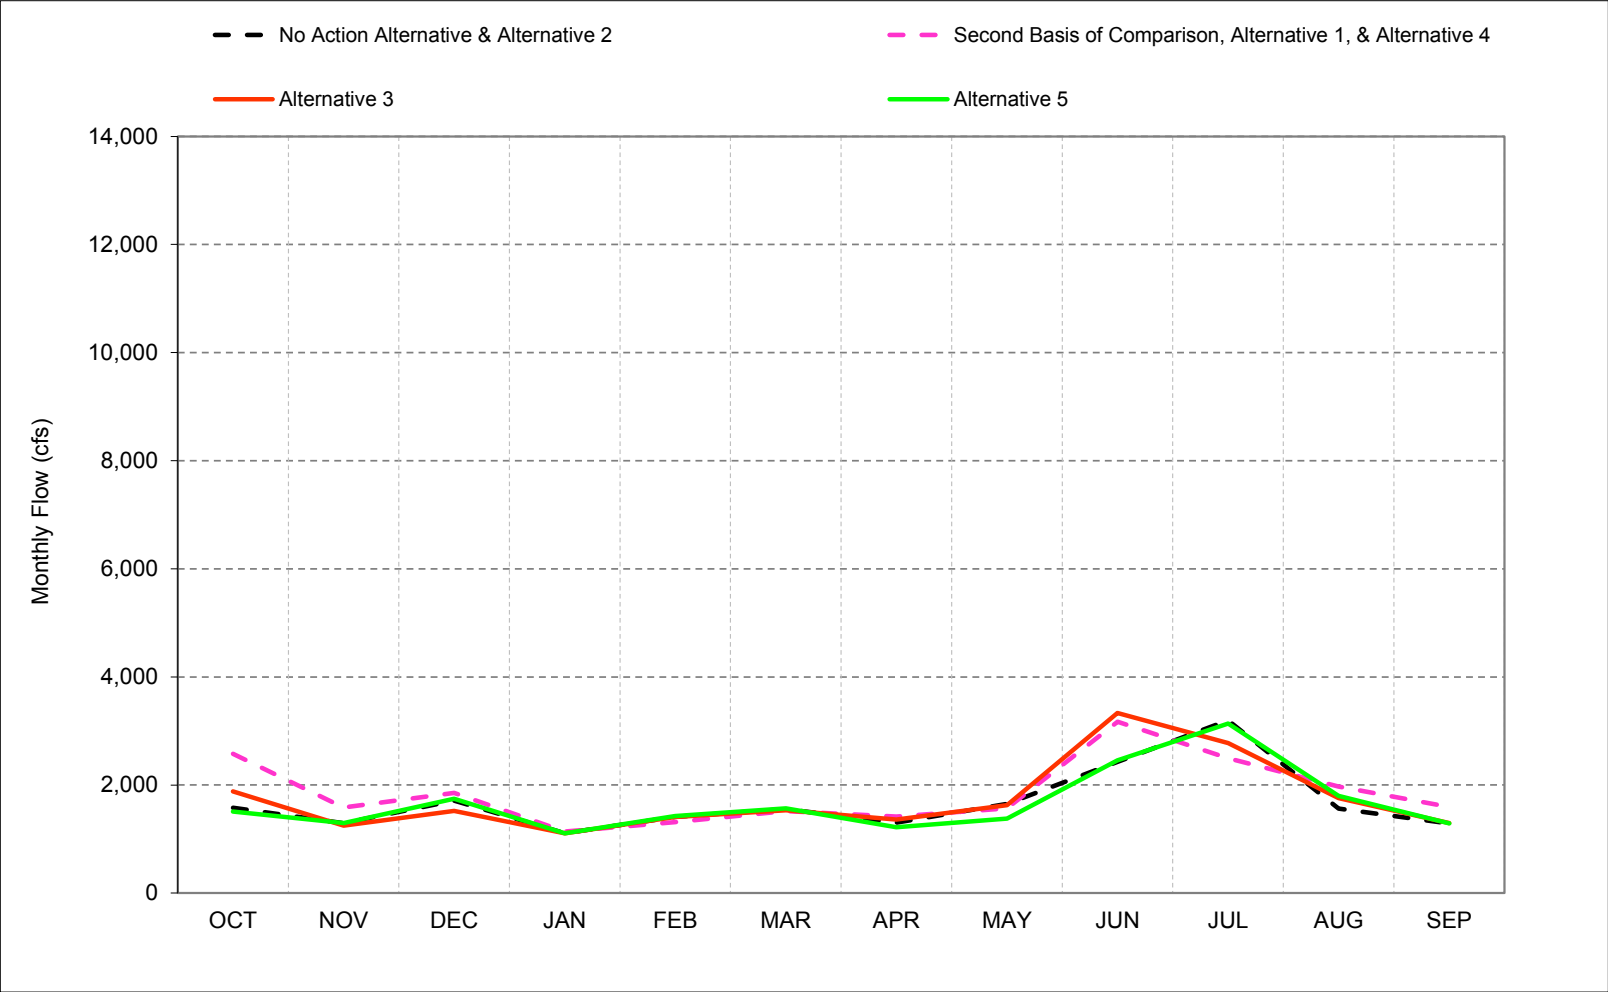

*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-25-1. Feather River d/s of Thermalito, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,000	2,500	5,220	13,743	14,312	13,576	8,403	8,298	5,577	10,000	8,144	10,000
20%	4,000	2,500	3,630	2,003	9,837	9,026	3,608	5,429	4,391	9,787	7,695	9,593
30%	4,000	2,500	1,823	1,700	3,741	6,580	2,690	2,791	3,939	9,427	7,343	8,157
40%	4,000	1,972	1,700	1,700	1,700	4,666	1,806	2,430	3,712	8,907	6,401	7,651
50%	1,898	1,700	1,700	1,700	1,700	1,700	1,104	1,920	3,311	8,572	4,991	5,642
60%	1,700	1,700	1,700	1,700	1,700	1,700	1,000	1,427	2,787	8,170	3,941	3,548
70%	1,700	1,200	1,700	1,200	1,700	1,700	1,000	1,000	2,524	6,244	2,167	1,424
80%	1,200	1,200	1,200	960	1,200	1,000	1,000	1,000	1,922	4,207	1,665	1,170
90%	902	900	901	900	900	800	759	1,000	1,378	2,246	1,229	1,000
Long Term												
Full Simulation Period ^b	2,553	1,991	2,769	4,356	5,170	6,055	3,069	3,455	3,376	7,275	4,802	5,364
Water Year Types^c												
Wet (32%)	2,929	2,680	4,053	10,322	11,983	13,155	6,595	6,942	3,800	7,817	5,835	9,265
Above Normal (16%)	2,235	1,740	2,676	2,369	3,681	6,808	1,938	2,081	2,935	9,586	7,727	7,802
Below Normal (13%)	3,050	2,018	2,338	1,595	1,589	1,941	1,281	1,778	2,954	8,948	6,371	3,350
Dry (24%)	2,583	1,662	2,032	1,360	1,505	1,296	1,264	1,821	3,909	6,594	2,635	2,261
Critical (15%)	1,578	1,295	1,709	1,108	1,413	1,555	1,305	1,650	2,431	3,196	1,566	1,290
Alternative 1												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,000	2,500	5,073	13,890	19,393	14,789	8,389	8,275	7,910	9,420	7,729	5,580
20%	4,000	2,500	3,420	2,988	11,501	11,022	3,686	6,352	6,635	9,054	6,656	5,247
30%	4,000	2,054	2,218	1,700	6,252	7,843	2,757	5,334	6,248	8,621	5,681	4,554
40%	3,974	1,700	1,700	1,700	2,379	5,528	1,853	3,369	5,222	8,022	4,745	3,796
50%	3,439	1,700	1,700	1,700	1,700	2,535	1,254	2,495	4,272	6,164	3,646	2,481
60%	2,492	1,700	1,700	1,700	1,700	1,700	1,000	1,956	3,834	4,837	2,691	1,904
70%	1,846	1,700	1,700	1,200	1,700	1,700	1,000	1,334	3,356	3,641	2,363	1,244
80%	1,700	1,200	1,374	1,200	1,200	1,000	1,000	1,000	2,525	3,030	1,955	1,051
90%	1,200	900	948	900	900	800	968	1,000	1,714	2,044	1,223	1,000
Long Term												
Full Simulation Period ^b	2,883	1,956	3,113	4,812	5,841	6,488	3,136	4,013	4,637	6,050	4,145	3,045
Water Year Types^c												
Wet (32%)	3,068	2,585	5,476	11,696	12,740	13,784	6,587	7,101	4,333	6,920	4,346	3,254
Above Normal (16%)	2,660	1,600	2,519	2,477	5,166	8,173	2,259	3,058	4,823	8,866	6,433	4,449
Below Normal (13%)	3,311	1,913	1,687	1,582	3,161	2,066	1,405	3,388	6,145	7,681	4,260	3,333
Dry (24%)	2,736	1,615	1,966	1,360	1,497	1,321	1,203	2,431	4,961	4,326	3,639	2,574
Critical (15%)	2,577	1,582	1,853	1,139	1,317	1,520	1,414	1,569	3,170	2,495	1,969	1,595
Alternative 1 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	-147	146	5,081	1,214	-14	-23	2,333	-580	-415	-4,420
20%	0	0	-210	985	1,663	1,996	78	924	2,244	-733	-1,039	-4,346
30%	0	-446	395	0	2,510	1,263	67	2,543	2,309	-806	-1,662	-3,603
40%	-26	-272	0	0	679	862	47	939	1,510	-885	-1,656	-3,856
50%	1,541	0	0	0	0	835	150	575	961	-2,408	-1,345	-3,160
60%	792	0	0	0	0	0	0	529	1,047	-3,333	-1,250	-1,644
70%	146	500	0	0	0	0	0	334	832	-2,604	196	-181
80%	500	0	174	240	0	0	0	0	604	-1,177	290	-119
90%	298	0	47	0	0	0	209	0	336	-202	-6	0
Long Term												
Full Simulation Period ^b	330	-36	344	455	671	433	66	558	1,261	-1,224	-657	-2,319
Water Year Types^c												
Wet (32%)	139	-94	1,423	1,373	757	628	-8	159	533	-897	-1,490	-6,011
Above Normal (16%)	425	-140	-157	107	1,485	1,365	322	977	1,888	-720	-1,294	-3,354
Below Normal (13%)	262	-105	-651	-13	1,573	125	125	1,611	3,192	-1,267	-2,111	-17
Dry (24%)	154	-46	-66	0	-8	24	-61	610	1,052	-2,268	1,004	313
Critical (15%)	999	287	144	31	-96	-36	109	-81	739	-701	403	305

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
^b Based on the 82-year simulation period.
^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-25-2. Feather River d/s of Thermalito, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,000	2,500	5,220	13,743	14,312	13,576	8,403	8,298	5,577	10,000	8,144	10,000
20%	4,000	2,500	3,630	2,003	9,837	9,026	3,608	5,429	4,391	9,787	7,695	9,593
30%	4,000	2,500	1,823	1,700	3,741	6,580	2,690	2,791	3,939	9,427	7,343	8,157
40%	4,000	1,972	1,700	1,700	1,700	4,666	1,806	2,430	3,712	8,907	6,401	7,651
50%	1,898	1,700	1,700	1,700	1,700	1,700	1,104	1,920	3,311	8,572	4,991	5,642
60%	1,700	1,700	1,700	1,700	1,700	1,700	1,000	1,427	2,787	8,170	3,941	3,548
70%	1,700	1,200	1,700	1,200	1,700	1,700	1,000	1,000	2,524	6,244	2,167	1,424
80%	1,200	1,200	1,200	960	1,200	1,000	1,000	1,000	1,922	4,207	1,665	1,170
90%	902	900	901	900	900	800	759	1,000	1,378	2,246	1,229	1,000
Long Term												
Full Simulation Period ^b	2,553	1,991	2,769	4,356	5,170	6,055	3,069	3,455	3,376	7,275	4,802	5,364
Water Year Types^c												
Wet (32%)	2,929	2,680	4,053	10,322	11,983	13,155	6,595	6,942	3,800	7,817	5,835	9,265
Above Normal (16%)	2,235	1,740	2,676	2,369	3,681	6,808	1,938	2,081	2,935	9,586	7,727	7,802
Below Normal (13%)	3,050	2,018	2,338	1,595	1,589	1,941	1,281	1,778	2,954	8,948	6,371	3,350
Dry (24%)	2,583	1,662	2,032	1,360	1,505	1,296	1,264	1,821	3,909	6,594	2,635	2,261
Critical (15%)	1,578	1,295	1,709	1,108	1,413	1,555	1,305	1,650	2,431	3,196	1,566	1,290
Alternative 3												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,000	2,500	5,285	14,314	16,714	13,573	8,396	8,298	6,837	10,000	8,031	5,388
20%	4,000	2,500	3,006	1,816	11,330	9,458	3,706	6,213	5,940	9,849	7,592	4,833
30%	4,000	1,700	1,755	1,700	5,977	7,640	2,833	4,432	5,428	9,452	6,512	3,781
40%	3,443	1,700	1,700	1,700	1,894	5,140	1,854	3,105	5,005	9,028	5,444	2,799
50%	2,035	1,700	1,700	1,700	1,700	2,508	1,230	2,641	4,563	8,667	4,544	2,222
60%	1,700	1,700	1,700	1,700	1,700	1,700	1,000	2,157	4,262	8,162	3,199	1,345
70%	1,700	1,200	1,700	1,200	1,700	1,700	1,000	1,669	3,798	5,497	2,312	1,197
80%	1,200	1,200	1,200	960	1,200	1,000	1,000	1,000	2,837	3,032	1,710	1,009
90%	902	900	904	900	900	800	853	1,000	2,107	2,030	1,231	1,000
Long Term												
Full Simulation Period ^b	2,522	1,908	2,918	4,703	5,682	6,314	3,153	3,950	4,520	7,081	4,530	2,715
Water Year Types^c												
Wet (32%)	2,908	2,630	5,192	11,483	12,535	13,516	6,589	7,176	4,718	7,672	4,754	2,778
Above Normal (16%)	2,325	1,662	2,480	2,222	4,471	7,646	2,262	2,966	4,267	9,637	7,249	4,476
Below Normal (13%)	2,884	1,880	1,730	1,606	3,168	2,067	1,509	2,669	4,424	9,449	6,830	2,788
Dry (24%)	2,330	1,542	1,738	1,362	1,505	1,290	1,247	2,494	5,190	5,932	2,869	2,301
Critical (15%)	1,885	1,251	1,524	1,108	1,410	1,533	1,360	1,627	3,335	2,775	1,757	1,296
Alternative 3 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	65	571	2,402	-3	-7	0	1,260	0	-113	-4,612
20%	0	0	-624	-187	1,493	432	98	784	1,550	63	-103	-4,760
30%	0	-800	-68	0	2,236	1,060	143	1,641	1,489	25	-830	-4,376
40%	-557	-272	0	0	194	474	48	675	1,294	121	-956	-4,853
50%	137	0	0	0	0	808	126	721	1,252	95	-447	-3,419
60%	0	0	0	0	0	0	0	731	1,474	-8	-742	-2,202
70%	0	0	0	0	0	0	0	669	1,274	-747	146	-227
80%	0	0	0	0	0	0	0	0	916	-1,174	45	-161
90%	0	0	3	0	0	0	94	0	729	-216	2	0
Long Term												
Full Simulation Period ^b	-31	-83	150	346	512	259	84	495	1,144	-194	-272	-2,649
Water Year Types^c												
Wet (32%)	-20	-50	1,139	1,161	552	360	-6	235	918	-145	-1,082	-6,487
Above Normal (16%)	90	-79	-195	-148	790	838	324	885	1,332	50	-478	-3,326
Below Normal (13%)	-166	-139	-608	11	1,580	125	228	891	1,470	501	459	-562
Dry (24%)	-253	-120	-294	2	0	-6	-17	673	1,281	-661	234	40
Critical (15%)	307	-44	-186	0	-2	-22	55	-22	904	-421	191	6

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
^b Based on the 82-year simulation period.
^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-25-3. Feather River d/s of Thermalito, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,000	2,500	5,220	13,743	14,312	13,576	8,403	8,298	5,577	10,000	8,144	10,000
20%	4,000	2,500	3,630	2,003	9,837	9,026	3,608	5,429	4,391	9,787	7,695	9,593
30%	4,000	2,500	1,823	1,700	3,741	6,580	2,690	2,791	3,939	9,427	7,343	8,157
40%	4,000	1,972	1,700	1,700	1,700	4,666	1,806	2,430	3,712	8,907	6,401	7,651
50%	1,898	1,700	1,700	1,700	1,700	1,700	1,104	1,920	3,311	8,572	4,991	5,642
60%	1,700	1,700	1,700	1,700	1,700	1,700	1,000	1,427	2,787	8,170	3,941	3,548
70%	1,700	1,200	1,700	1,200	1,700	1,700	1,000	1,000	2,524	6,244	2,167	1,424
80%	1,200	1,200	1,200	960	1,200	1,000	1,000	1,000	1,922	4,207	1,665	1,170
90%	902	900	901	900	900	800	759	1,000	1,378	2,246	1,229	1,000
Long Term												
Full Simulation Period ^b	2,553	1,991	2,769	4,356	5,170	6,055	3,069	3,455	3,376	7,275	4,802	5,364
Water Year Types^c												
Wet (32%)	2,929	2,680	4,053	10,322	11,983	13,155	6,595	6,942	3,800	7,817	5,835	9,265
Above Normal (16%)	2,235	1,740	2,676	2,369	3,681	6,808	1,938	2,081	2,935	9,586	7,727	7,802
Below Normal (13%)	3,050	2,018	2,338	1,595	1,589	1,941	1,281	1,778	2,954	8,948	6,371	3,350
Dry (24%)	2,583	1,662	2,032	1,360	1,505	1,296	1,264	1,821	3,909	6,594	2,635	2,261
Critical (15%)	1,578	1,295	1,709	1,108	1,413	1,555	1,305	1,650	2,431	3,196	1,566	1,290

Alternative 5												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,000	2,500	5,231	13,726	14,296	13,578	8,400	8,302	5,058	10,000	8,153	10,000
20%	4,000	2,500	3,623	2,007	10,475	9,029	3,609	5,429	4,304	9,954	7,732	9,613
30%	4,000	2,500	1,829	1,700	3,773	6,115	2,576	2,423	4,000	9,417	7,482	8,113
40%	4,000	2,031	1,700	1,700	1,700	4,669	1,805	1,708	3,726	8,981	6,683	7,599
50%	1,898	1,700	1,700	1,700	1,700	1,700	1,062	1,434	3,282	8,651	5,737	5,685
60%	1,700	1,700	1,700	1,700	1,700	1,700	1,000	1,156	2,772	8,291	3,988	3,116
70%	1,700	1,222	1,700	1,200	1,700	1,700	1,000	1,000	2,483	6,076	2,503	1,553
80%	1,200	1,200	1,200	960	1,200	1,000	1,000	1,000	1,915	4,810	1,766	1,190
90%	900	900	901	900	900	800	751	1,000	1,313	2,253	1,284	1,000
Long Term												
Full Simulation Period ^b	2,547	2,010	2,781	4,298	5,160	6,046	3,051	3,229	3,351	7,389	4,998	5,365
Water Year Types^c												
Wet (32%)	2,942	2,681	4,073	10,143	11,984	13,175	6,596	6,943	3,764	7,907	5,996	9,171
Above Normal (16%)	2,237	1,834	2,674	2,357	3,602	6,700	1,937	1,959	2,913	9,601	7,728	7,796
Below Normal (13%)	3,049	2,018	2,338	1,595	1,589	1,946	1,281	1,420	2,828	9,007	6,773	3,521
Dry (24%)	2,584	1,675	2,038	1,360	1,505	1,296	1,242	1,328	3,924	6,938	2,869	2,298
Critical (15%)	1,507	1,295	1,743	1,108	1,426	1,566	1,218	1,382	2,459	3,139	1,798	1,287

Alternative 5 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	11	-18	-16	3	-3	5	-519	0	9	0
20%	0	0	-7	4	638	3	1	1	-87	168	37	20
30%	0	0	6	0	32	-465	-114	-368	62	-9	139	-44
40%	0	59	0	0	0	3	-1	-722	15	74	282	-52
50%	0	0	0	0	0	0	-42	-486	-29	79	746	43
60%	0	0	0	0	0	0	0	-270	-16	121	46	-431
70%	0	22	0	0	0	0	0	0	-40	-168	336	128
80%	0	0	0	0	0	0	0	0	-6	604	101	21
90%	-2	0	0	0	0	0	-8	0	-65	7	55	0
Long Term												
Full Simulation Period ^b	-5	19	13	-59	-10	-9	-18	-226	-24	114	196	1
Water Year Types^c												
Wet (32%)	13	1	20	-180	2	20	1	1	-36	90	161	-94
Above Normal (16%)	2	94	-2	-12	-79	-108	-1	-122	-23	15	1	-6
Below Normal (13%)	0	0	-1	0	0	4	0	-358	-126	58	401	171
Dry (24%)	1	14	6	0	0	0	-22	-493	15	344	234	37
Critical (15%)	-71	-1	34	0	13	11	-87	-268	27	-57	232	-2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-25-4. Feather River d/s of Thermalito, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,000	2,500	5,073	13,890	19,393	14,789	8,389	8,275	7,910	9,420	7,729	5,580
20%	4,000	2,500	3,420	2,988	11,501	11,022	3,686	6,352	6,635	9,054	6,656	5,247
30%	4,000	2,054	2,218	1,700	6,252	7,843	2,757	5,334	6,248	8,621	5,681	4,554
40%	3,974	1,700	1,700	1,700	2,379	5,528	1,853	3,369	5,222	8,022	4,745	3,796
50%	3,439	1,700	1,700	1,700	1,700	2,535	1,254	2,495	4,272	6,164	3,646	2,481
60%	2,492	1,700	1,700	1,700	1,700	1,700	1,000	1,956	3,834	4,837	2,691	1,904
70%	1,846	1,700	1,700	1,200	1,700	1,700	1,000	1,334	3,356	3,641	2,363	1,244
80%	1,700	1,200	1,374	1,200	1,200	1,000	1,000	1,000	2,525	3,030	1,955	1,051
90%	1,200	900	948	900	900	800	968	1,000	1,714	2,044	1,223	1,000
Long Term												
Full Simulation Period ^b	2,883	1,956	3,113	4,812	5,841	6,488	3,136	4,013	4,637	6,050	4,145	3,045
Water Year Types^c												
Wet (32%)	3,068	2,585	5,476	11,696	12,740	13,784	6,587	7,101	4,333	6,920	4,346	3,254
Above Normal (16%)	2,660	1,600	2,519	2,477	5,166	8,173	2,259	3,058	4,823	8,866	6,433	4,449
Below Normal (13%)	3,311	1,913	1,687	1,582	3,161	2,066	1,405	3,388	6,145	7,681	4,260	3,333
Dry (24%)	2,736	1,615	1,966	1,360	1,497	1,321	1,203	2,431	4,961	4,326	3,639	2,574
Critical (15%)	2,577	1,582	1,853	1,139	1,317	1,520	1,414	1,569	3,170	2,495	1,969	1,595

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,000	2,500	5,220	13,743	14,312	13,576	8,403	8,298	5,577	10,000	8,144	10,000
20%	4,000	2,500	3,630	2,003	9,837	9,026	3,608	5,429	4,391	9,787	7,695	9,593
30%	4,000	2,500	1,823	1,700	3,741	6,580	2,690	2,791	3,939	9,427	7,343	8,157
40%	4,000	1,972	1,700	1,700	1,700	4,666	1,806	2,430	3,712	8,907	6,401	7,651
50%	1,898	1,700	1,700	1,700	1,700	1,700	1,104	1,920	3,311	8,572	4,991	5,642
60%	1,700	1,700	1,700	1,700	1,700	1,700	1,000	1,427	2,787	8,170	3,941	3,548
70%	1,700	1,200	1,700	1,200	1,700	1,700	1,000	1,000	2,524	6,244	2,167	1,424
80%	1,200	1,200	1,200	960	1,200	1,000	1,000	1,000	1,922	4,207	1,665	1,170
90%	902	900	901	900	900	800	759	1,000	1,378	2,246	1,229	1,000
Long Term												
Full Simulation Period ^b	2,553	1,991	2,769	4,356	5,170	6,055	3,069	3,455	3,376	7,275	4,802	5,364
Water Year Types^c												
Wet (32%)	2,929	2,680	4,053	10,322	11,983	13,155	6,595	6,942	3,800	7,817	5,835	9,265
Above Normal (16%)	2,235	1,740	2,676	2,369	3,681	6,808	1,938	2,081	2,935	9,586	7,727	7,802
Below Normal (13%)	3,050	2,018	2,338	1,595	1,589	1,941	1,281	1,778	2,954	8,948	6,371	3,350
Dry (24%)	2,583	1,662	2,032	1,360	1,505	1,296	1,264	1,821	3,909	6,594	2,635	2,261
Critical (15%)	1,578	1,295	1,709	1,108	1,413	1,555	1,305	1,650	2,431	3,196	1,566	1,290

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	147	-146	-5,081	-1,214	14	23	-2,333	580	415	4,420
20%	0	0	210	-985	-1,663	-1,996	-78	-924	-2,244	733	1,039	4,346
30%	0	446	-395	0	-2,510	-1,263	-67	-2,543	-2,309	806	1,662	3,603
40%	26	272	0	0	-679	-862	-47	-939	-1,510	885	1,656	3,856
50%	-1,541	0	0	0	0	-835	-150	-575	-961	2,408	1,345	3,160
60%	-792	0	0	0	0	0	0	-529	-1,047	3,333	1,250	1,644
70%	-146	-500	0	0	0	0	0	-334	-832	2,604	-196	181
80%	-500	0	-174	-240	0	0	0	0	-604	1,177	-290	119
90%	-298	0	-47	0	0	0	-209	0	-336	202	6	0
Long Term												
Full Simulation Period ^b	-330	36	-344	-455	-671	-433	-66	-558	-1,261	1,224	657	2,319
Water Year Types^c												
Wet (32%)	-139	94	-1,423	-1,373	-757	-628	8	-159	-533	897	1,490	6,011
Above Normal (16%)	-425	140	157	-107	-1,485	-1,365	-322	-977	-1,888	720	1,294	3,354
Below Normal (13%)	-262	105	651	13	-1,573	-125	-125	-1,611	-3,192	1,267	2,111	17
Dry (24%)	-154	46	66	0	8	-24	61	-610	-1,052	2,268	-1,004	-313
Critical (15%)	-999	-287	-144	-31	96	36	-109	81	-739	701	-403	-305

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-25-5. Feather River d/s of Thermalito, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,000	2,500	5,073	13,890	19,393	14,789	8,389	8,275	7,910	9,420	7,729	5,580
20%	4,000	2,500	3,420	2,988	11,501	11,022	3,686	6,352	6,635	9,054	6,656	5,247
30%	4,000	2,054	2,218	1,700	6,252	7,843	2,757	5,334	6,248	8,621	5,681	4,554
40%	3,974	1,700	1,700	1,700	2,379	5,528	1,853	3,369	5,222	8,022	4,745	3,796
50%	3,439	1,700	1,700	1,700	1,700	2,535	1,254	2,495	4,272	6,164	3,646	2,481
60%	2,492	1,700	1,700	1,700	1,700	1,700	1,000	1,956	3,834	4,837	2,691	1,904
70%	1,846	1,700	1,700	1,200	1,700	1,700	1,000	1,334	3,356	3,641	2,363	1,244
80%	1,700	1,200	1,374	1,200	1,200	1,000	1,000	1,000	2,525	3,030	1,955	1,051
90%	1,200	900	948	900	900	800	968	1,000	1,714	2,044	1,223	1,000
Long Term												
Full Simulation Period ^b	2,883	1,956	3,113	4,812	5,841	6,488	3,136	4,013	4,637	6,050	4,145	3,045
Water Year Types^c												
Wet (32%)	3,068	2,585	5,476	11,696	12,740	13,784	6,587	7,101	4,333	6,920	4,346	3,254
Above Normal (16%)	2,660	1,600	2,519	2,477	5,166	8,173	2,259	3,058	4,823	8,866	6,433	4,449
Below Normal (13%)	3,311	1,913	1,687	1,582	3,161	2,066	1,405	3,388	6,145	7,681	4,260	3,333
Dry (24%)	2,736	1,615	1,966	1,360	1,497	1,321	1,203	2,431	4,961	4,326	3,639	2,574
Critical (15%)	2,577	1,582	1,853	1,139	1,317	1,520	1,414	1,569	3,170	2,495	1,969	1,595

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,000	2,500	5,285	14,314	16,714	13,573	8,396	8,298	6,837	10,000	8,031	5,388
20%	4,000	2,500	3,006	1,816	11,330	9,458	3,706	6,213	5,940	9,849	7,592	4,833
30%	4,000	1,700	1,755	1,700	5,977	7,640	2,833	4,432	5,428	9,452	6,512	3,781
40%	3,443	1,700	1,700	1,700	1,894	5,140	1,854	3,105	5,005	9,028	5,444	2,799
50%	2,035	1,700	1,700	1,700	1,700	2,508	1,230	2,641	4,563	8,667	4,544	2,222
60%	1,700	1,700	1,700	1,700	1,700	1,700	1,000	2,157	4,262	8,162	3,199	1,345
70%	1,700	1,200	1,700	1,200	1,700	1,700	1,000	1,669	3,798	5,497	2,312	1,197
80%	1,200	1,200	1,200	960	1,200	1,000	1,000	1,000	2,837	3,032	1,710	1,009
90%	900	900	904	900	900	800	853	1,000	2,107	2,030	1,231	1,000
Long Term												
Full Simulation Period ^b	2,522	1,908	2,918	4,703	5,682	6,314	3,153	3,950	4,520	7,081	4,530	2,715
Water Year Types^c												
Wet (32%)	2,908	2,630	5,192	11,483	12,535	13,516	6,589	7,176	4,718	7,672	4,754	2,778
Above Normal (16%)	2,325	1,662	2,480	2,222	4,471	7,646	2,262	2,966	4,267	9,637	7,249	4,476
Below Normal (13%)	2,884	1,880	1,730	1,606	3,168	2,067	1,509	2,669	4,424	9,449	6,830	2,788
Dry (24%)	2,330	1,542	1,738	1,362	1,505	1,290	1,247	2,494	5,190	5,932	2,869	2,301
Critical (15%)	1,885	1,251	1,524	1,108	1,410	1,533	1,360	1,627	3,335	2,775	1,757	1,296

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	212	424	-2,679	-1,216	8	23	-1,073	580	302	-192
20%	0	0	-414	-1,172	-171	-1,564	21	-140	-695	796	936	-415
30%	0	-354	-463	0	-275	-203	76	-901	-820	831	832	-773
40%	-531	0	0	0	-485	-387	1	-264	-216	1,005	700	-997
50%	-1,403	0	0	0	0	-27	-24	146	291	2,503	898	-259
60%	-792	0	0	0	0	0	0	202	428	3,325	508	-559
70%	-146	-500	0	0	0	0	0	335	442	1,857	-50	-47
80%	-500	0	-174	-240	0	0	0	0	312	2	-245	-42
90%	-298	0	-44	0	0	0	-114	0	393	-14	8	0
Long Term												
Full Simulation Period ^b	-361	-47	-194	-109	-159	-174	18	-63	-117	1,031	385	-330
Water Year Types^c												
Wet (32%)	-159	44	-284	-213	-205	-268	2	75	385	753	408	-476
Above Normal (16%)	-335	62	-39	-255	-695	-528	3	-92	-556	770	816	27
Below Normal (13%)	-428	-33	43	24	7	0	103	-719	-1,722	1,768	2,569	-545
Dry (24%)	-407	-73	-228	2	8	-31	44	63	228	1,606	-770	-274
Critical (15%)	-692	-331	-329	-31	94	13	-54	59	165	280	-212	-299

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-25-6. Feather River d/s of Thermalito, Monthly Flow

Second Basis of Comparison												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,000	2,500	5,073	13,890	19,393	14,789	8,389	8,275	7,910	9,420	7,729	5,580
20%	4,000	2,500	3,420	2,988	11,501	11,022	3,686	6,352	6,635	9,054	6,656	5,247
30%	4,000	2,054	2,218	1,700	6,252	7,843	2,757	5,334	6,248	8,621	5,681	4,554
40%	3,974	1,700	1,700	1,700	2,379	5,528	1,853	3,369	5,222	8,022	4,745	3,796
50%	3,439	1,700	1,700	1,700	1,700	2,535	1,254	2,495	4,272	6,164	3,646	2,481
60%	2,492	1,700	1,700	1,700	1,700	1,700	1,000	1,956	3,834	4,837	2,691	1,904
70%	1,846	1,700	1,700	1,200	1,700	1,700	1,000	1,334	3,356	3,641	2,363	1,244
80%	1,700	1,200	1,374	1,200	1,200	1,000	1,000	1,000	2,525	3,030	1,955	1,051
90%	1,200	900	948	900	900	800	968	1,000	1,714	2,044	1,223	1,000
Long Term												
Full Simulation Period ^b	2,883	1,956	3,113	4,812	5,841	6,488	3,136	4,013	4,637	6,050	4,145	3,045
Water Year Types^c												
Wet (32%)	3,068	2,585	5,476	11,696	12,740	13,784	6,587	7,101	4,333	6,920	4,346	3,254
Above Normal (16%)	2,660	1,600	2,519	2,477	5,166	8,173	2,259	3,058	4,823	8,866	6,433	4,449
Below Normal (13%)	3,311	1,913	1,687	1,582	3,161	2,066	1,405	3,388	6,145	7,681	4,260	3,333
Dry (24%)	2,736	1,615	1,966	1,360	1,497	1,321	1,203	2,431	4,961	4,326	3,639	2,574
Critical (15%)	2,577	1,582	1,853	1,139	1,317	1,520	1,414	1,569	3,170	2,495	1,969	1,595

Alternative 5

Alternative 5												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,000	2,500	5,231	13,726	14,296	13,578	8,400	8,302	5,058	10,000	8,153	10,000
20%	4,000	2,500	3,623	2,007	10,475	9,029	3,609	5,429	4,304	9,954	7,732	9,613
30%	4,000	2,500	1,829	1,700	3,773	6,115	2,576	2,423	4,000	9,417	7,482	8,113
40%	4,000	2,031	1,700	1,700	1,700	4,669	1,805	1,708	3,726	8,981	6,683	7,599
50%	1,898	1,700	1,700	1,700	1,700	1,700	1,062	1,434	3,282	8,651	5,737	5,685
60%	1,700	1,700	1,700	1,700	1,700	1,700	1,000	1,156	2,772	8,291	3,988	3,116
70%	1,700	1,222	1,700	1,200	1,700	1,700	1,000	1,000	2,483	6,076	2,503	1,553
80%	1,200	1,200	1,200	960	1,200	1,000	1,000	1,000	1,915	4,810	1,766	1,190
90%	900	900	901	900	900	800	751	1,000	1,313	2,253	1,284	1,000
Long Term												
Full Simulation Period ^b	2,547	2,010	2,781	4,298	5,160	6,046	3,051	3,229	3,351	7,389	4,998	5,365
Water Year Types^c												
Wet (32%)	2,942	2,681	4,073	10,143	11,984	13,175	6,596	6,943	3,764	7,907	5,996	9,171
Above Normal (16%)	2,237	1,834	2,674	2,357	3,602	6,700	1,937	1,959	2,913	9,601	7,728	7,796
Below Normal (13%)	3,049	2,018	2,338	1,595	1,589	1,946	1,281	1,420	2,828	9,007	6,773	3,521
Dry (24%)	2,584	1,675	2,038	1,360	1,505	1,296	1,242	1,328	3,924	6,938	2,869	2,298
Critical (15%)	1,507	1,295	1,743	1,108	1,426	1,566	1,218	1,382	2,459	3,139	1,798	1,287

Alternative 5 minus Second Basis of Comparison

Alternative 5 minus Second Basis of Comparison												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	158	-164	-5,097	-1,211	11	27	-2,852	580	425	4,420
20%	0	0	203	-981	-1,026	-1,993	-77	-923	-2,331	901	1,076	4,366
30%	0	446	-389	0	-2,478	-1,728	-181	-2,911	-2,247	797	1,801	3,559
40%	26	331	0	0	-679	-859	-48	-1,661	-1,495	958	1,938	3,803
50%	-1,541	0	0	0	0	-835	-192	-1,061	-990	2,488	2,091	3,203
60%	-792	0	0	0	0	0	0	-800	-1,062	3,454	1,297	1,212
70%	-146	-478	0	0	0	0	0	-334	-872	2,436	140	309
80%	-500	0	-174	-240	0	0	0	0	-610	1,781	-189	139
90%	-300	0	-47	0	0	0	-217	0	-400	209	61	0
Long Term												
Full Simulation Period ^b	-336	54	-331	-514	-681	-442	-84	-785	-1,286	1,339	853	2,320
Water Year Types^c												
Wet (32%)	-126	95	-1,403	-1,553	-756	-609	9	-158	-569	988	1,651	5,917
Above Normal (16%)	-423	234	155	-119	-1,564	-1,474	-322	-1,099	-1,911	735	1,295	3,348
Below Normal (13%)	-262	105	650	13	-1,573	-121	-125	-1,969	-3,317	1,325	2,512	188
Dry (24%)	-152	60	72	0	8	-25	39	-1,103	-1,038	2,612	-770	-276
Critical (15%)	-1,070	-287	-110	-31	109	47	-196	-187	-712	644	-171	-307

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1 **C.26. Fremont Weir Spills**


Figure C-26-1. Fremont Weir, Long-Term* Average Spills

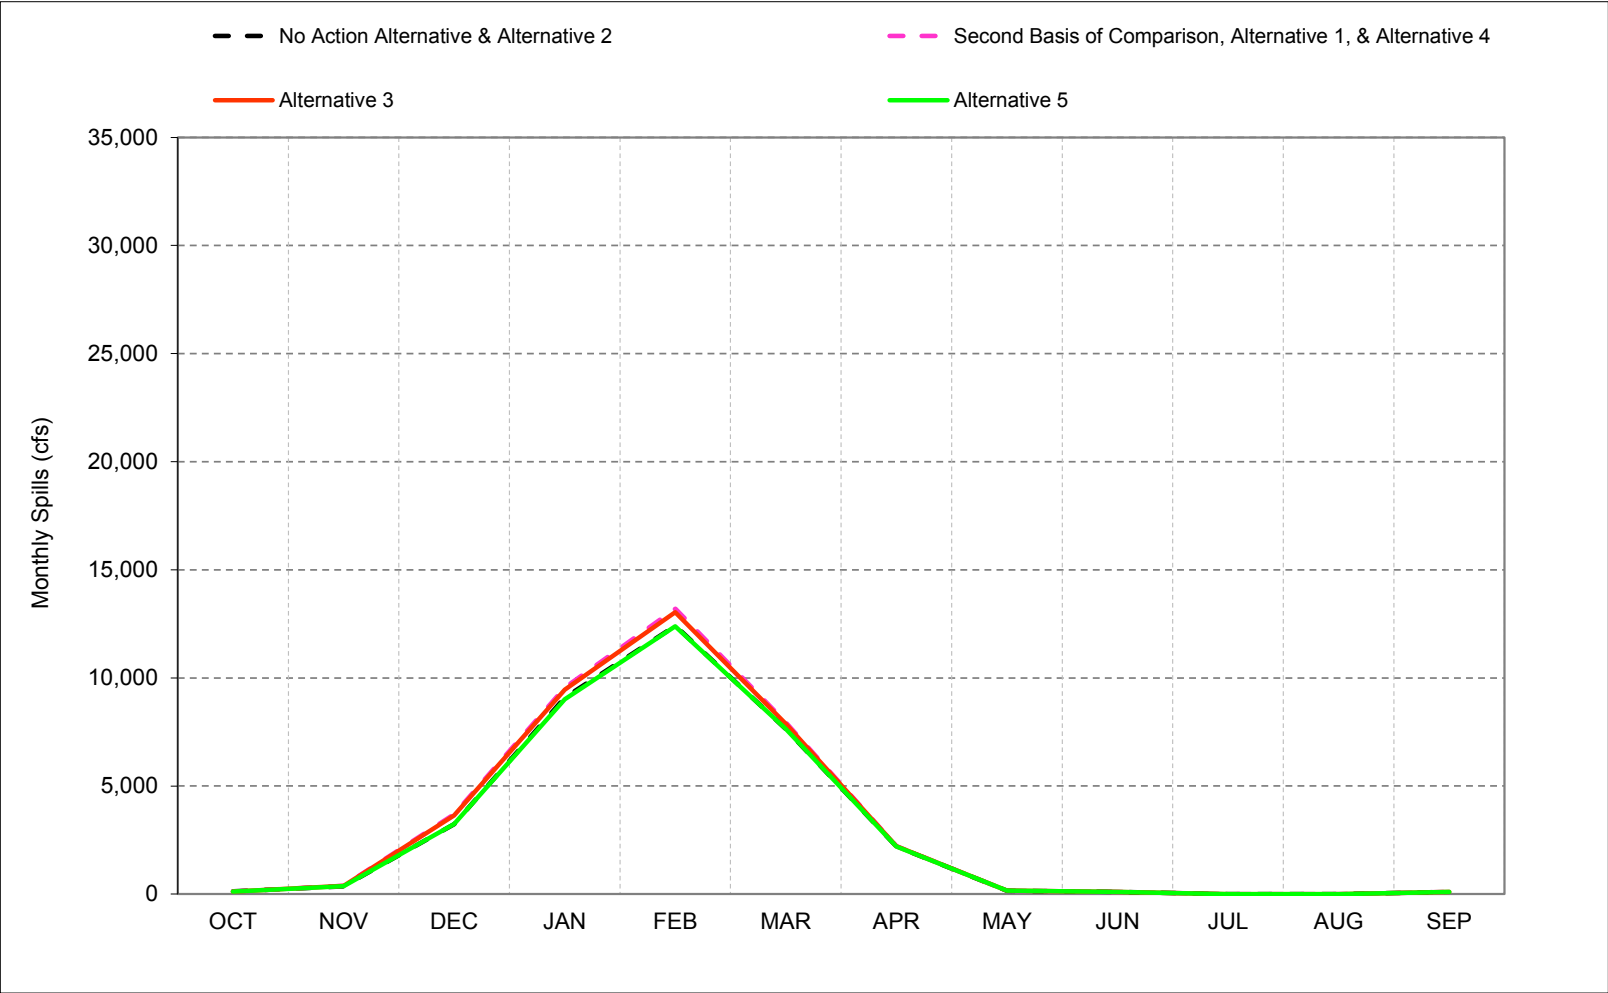

*Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-26-2. Fremont Weir, Wet Year* Long-Term** Average Spills

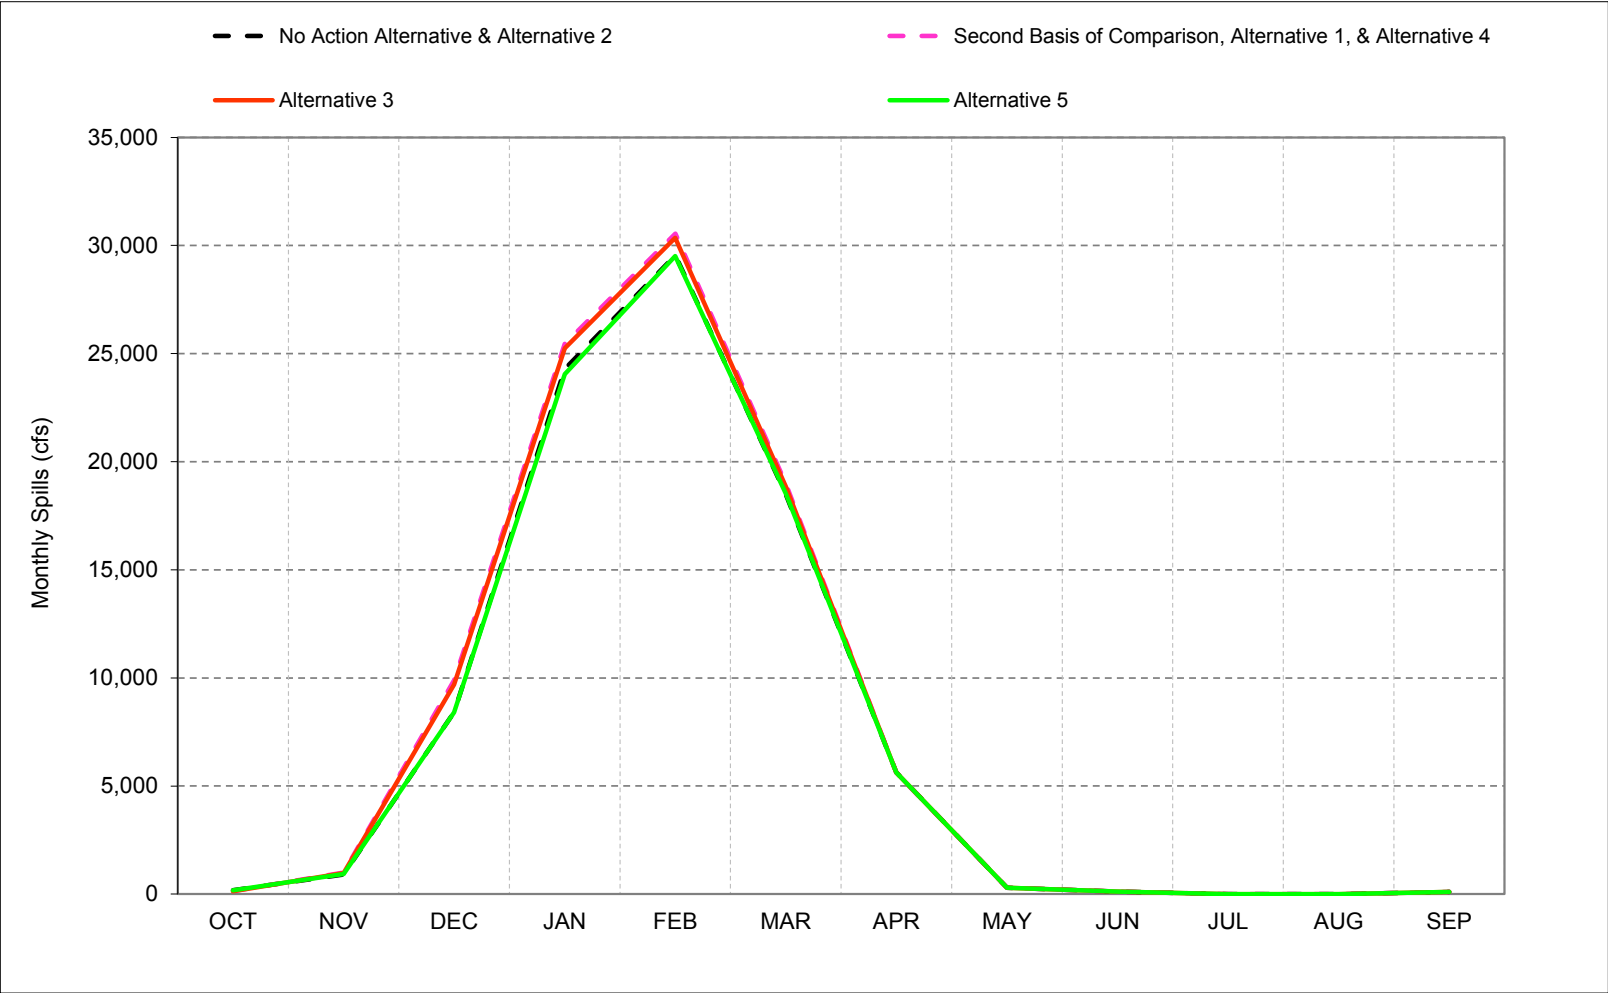


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-26-3. Fremont Weir, Above Normal Year* Long-Term** Average Spills

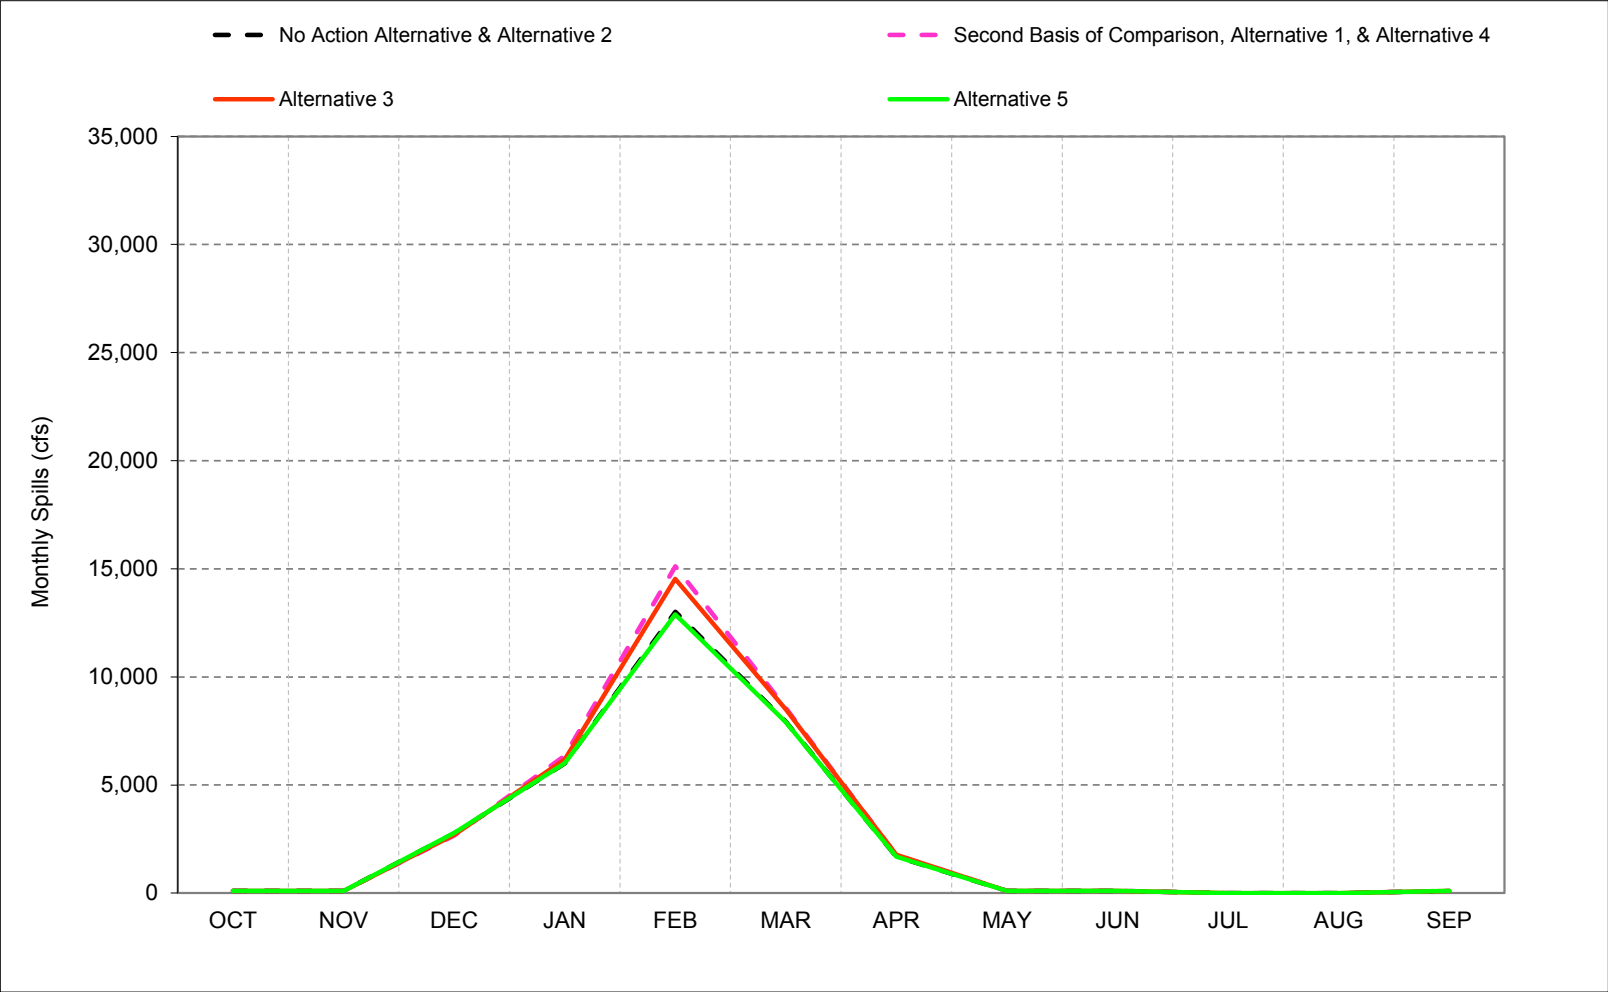


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-26-4. Fremont Weir, Below Normal Year* Long-Term** Average Spills

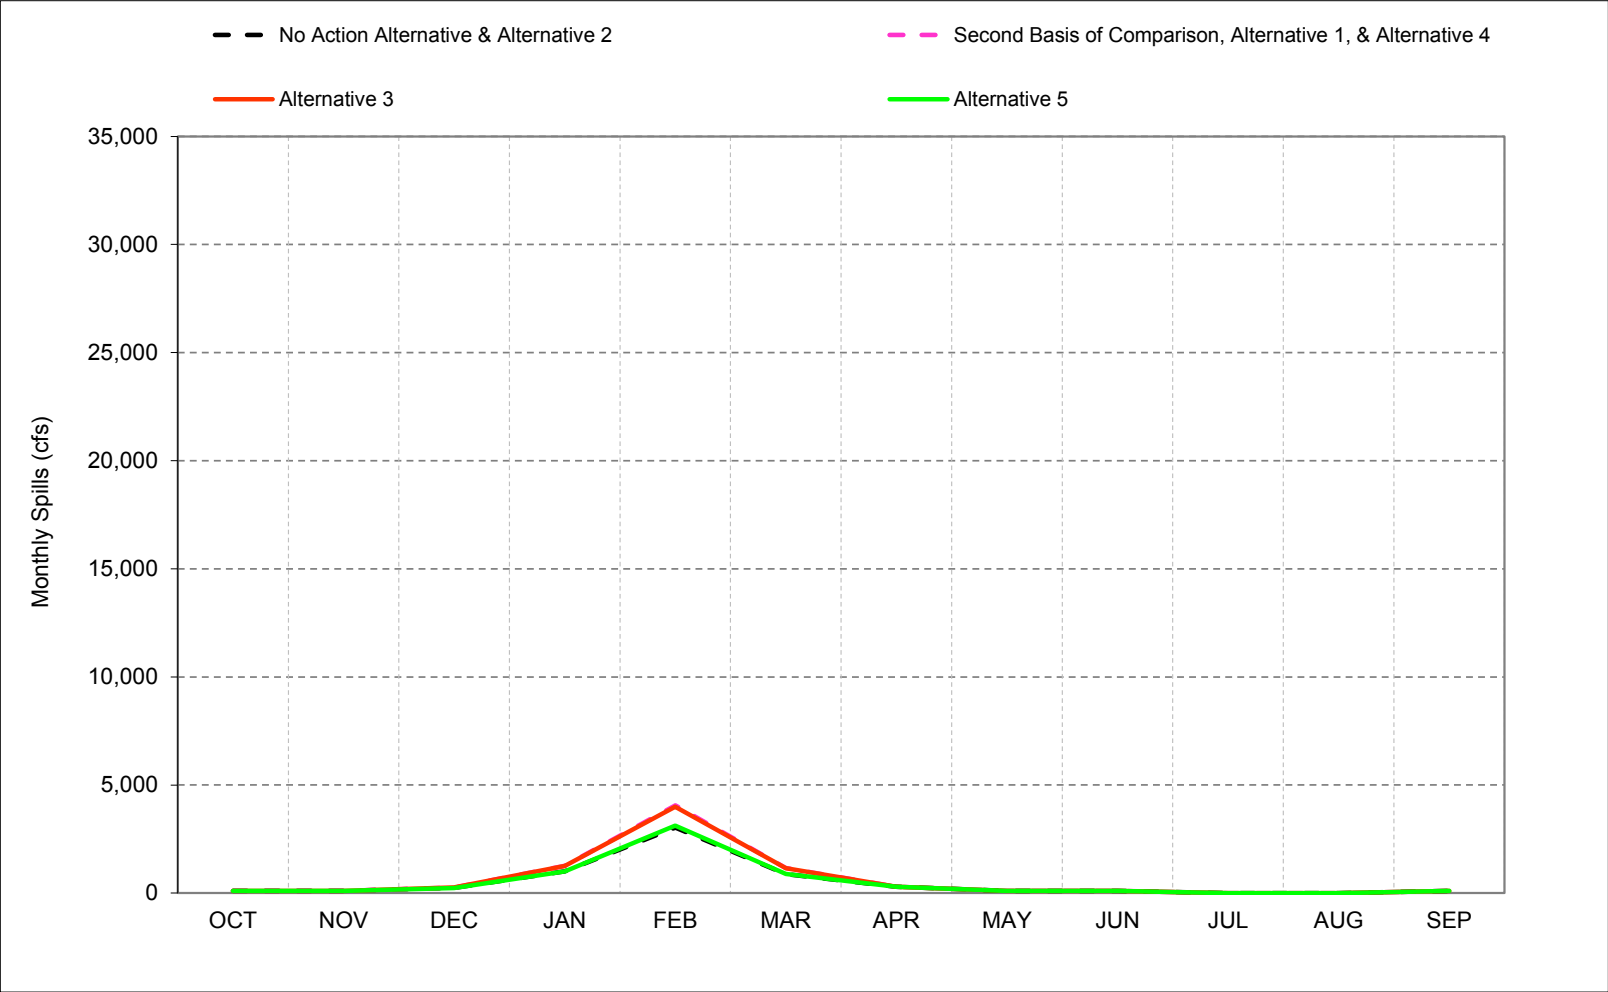


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-26-5. Fremont Weir, Dry Year* Long-Term** Average Spills

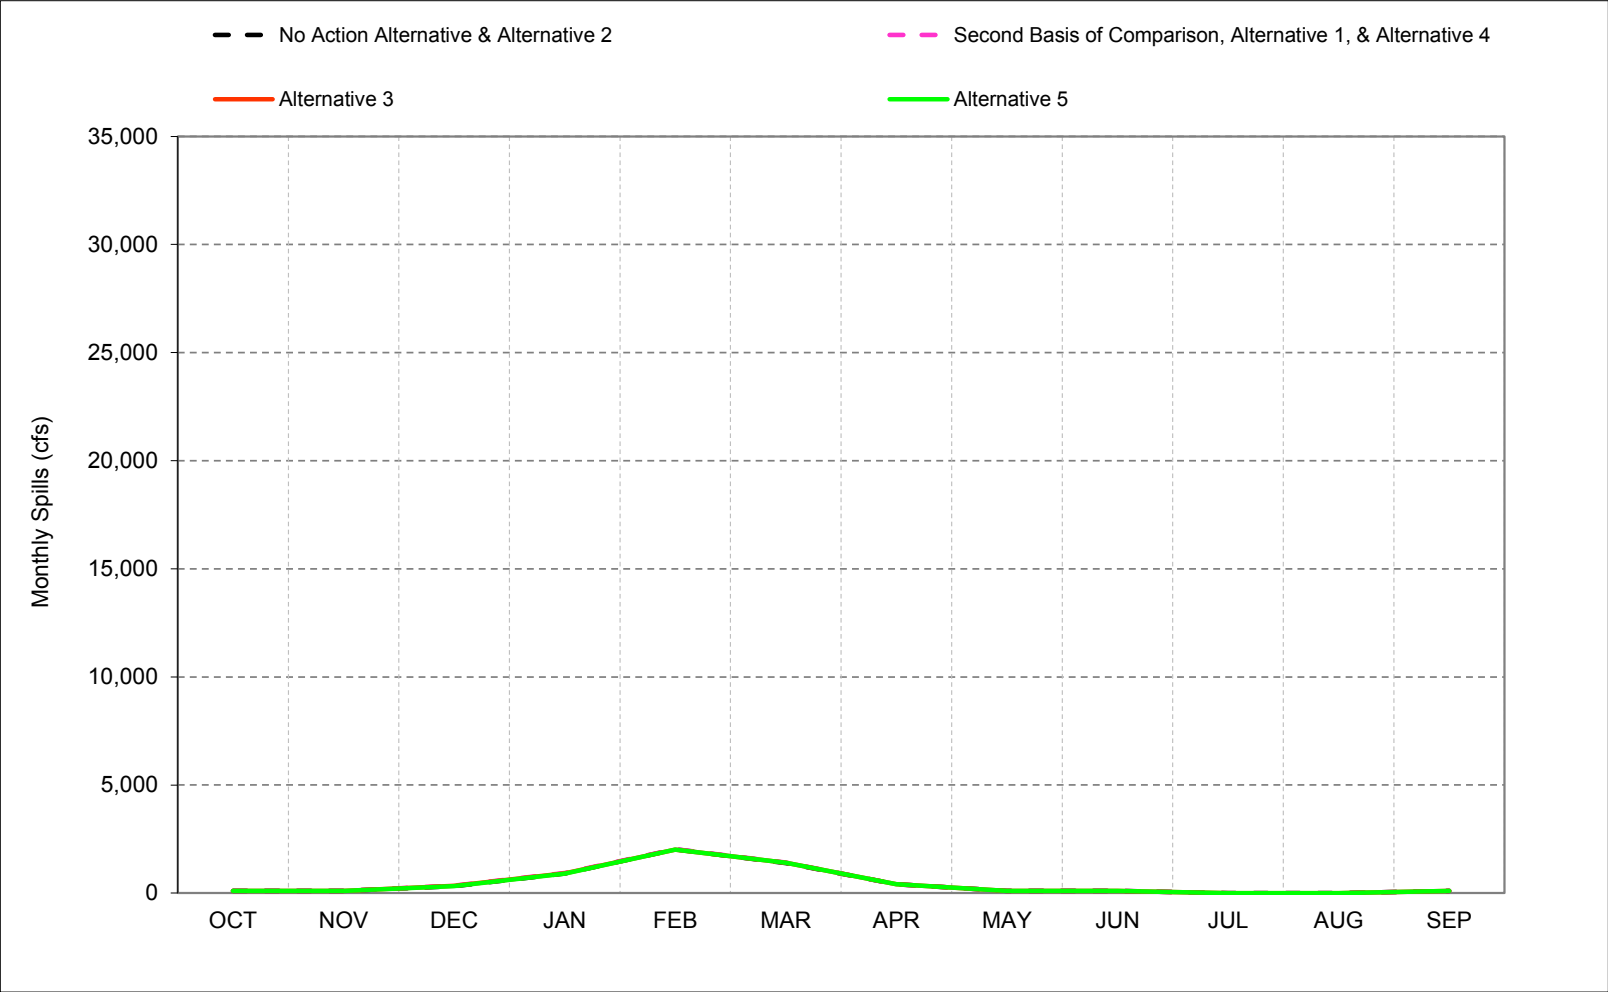


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-26-6. Fremont Weir, Critical Year* Long-Term** Average Spills

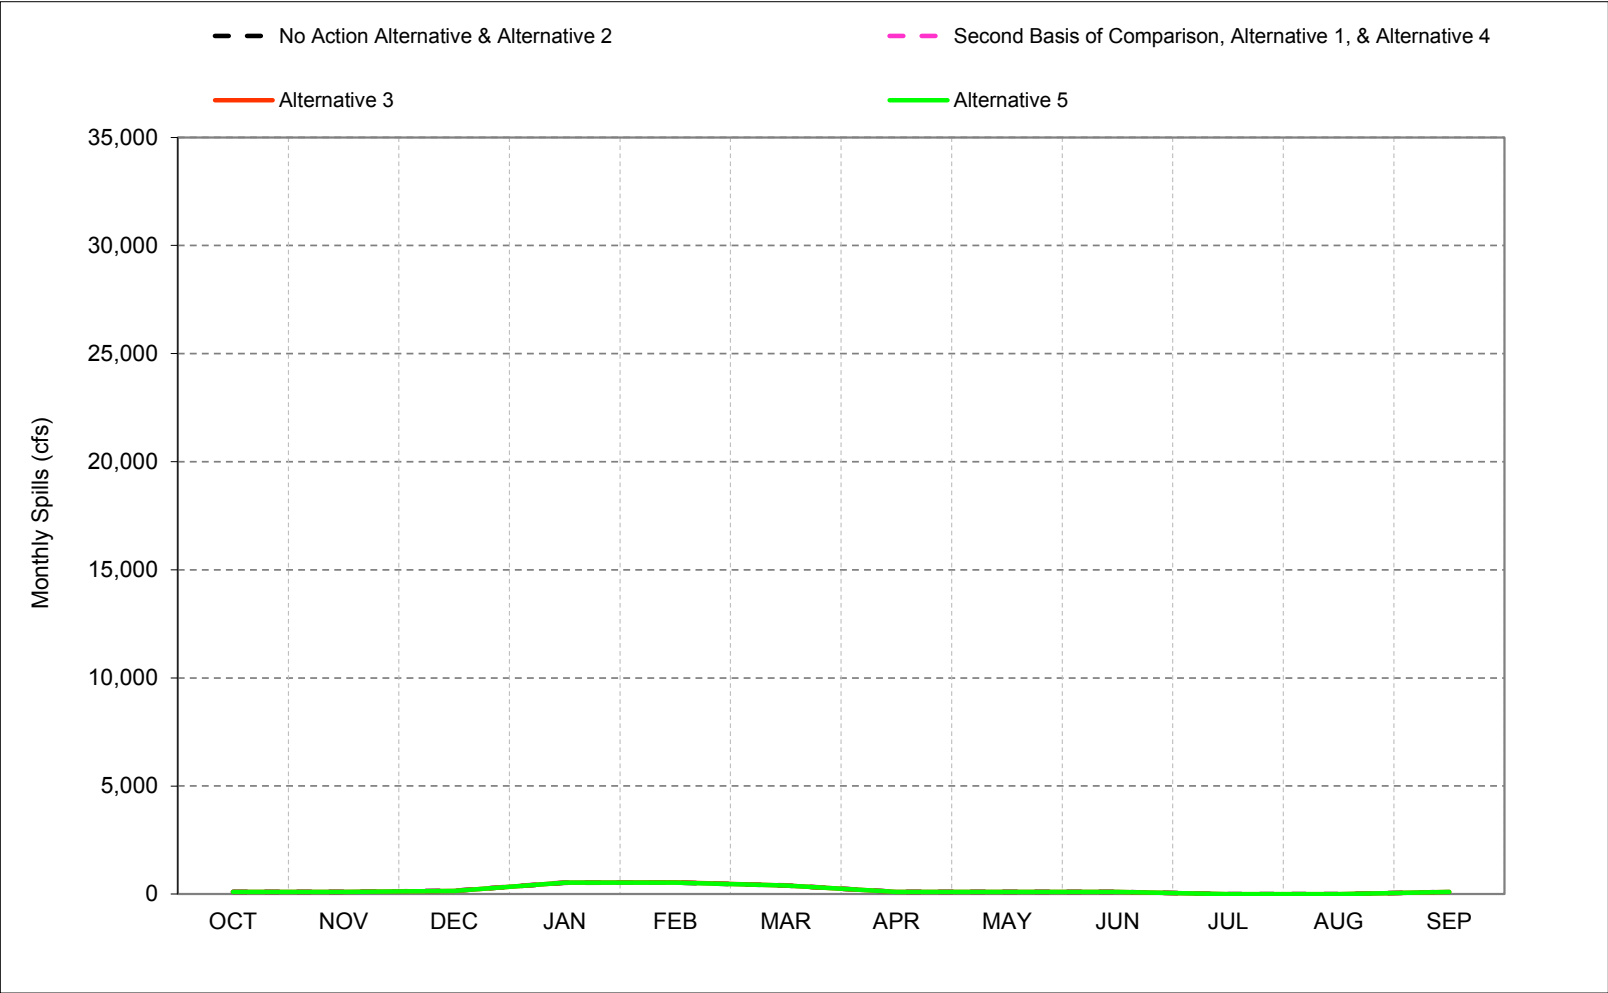

*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-26-1. Fremont Weir, Monthly Spills

No Action Alternative												
Statistic	Monthly Spills (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	100	100	7,229	23,972	40,788	16,077	5,836	100	100	0	0	100
20%	100	100	3,479	10,411	12,582	6,630	3,995	100	100	0	0	100
30%	100	100	1,219	5,246	7,068	4,531	884	100	100	0	0	100
40%	100	100	507	2,721	5,249	3,462	340	100	100	0	0	100
50%	100	100	185	1,412	3,305	1,749	114	100	100	0	0	100
60%	100	100	100	683	2,173	975	100	100	100	0	0	100
70%	100	100	100	145	932	321	100	100	100	0	0	100
80%	100	100	100	100	187	176	100	100	100	0	0	100
90%	100	100	100	100	100	100	100	100	100	0	0	100
Long Term												
Full Simulation Period ^b	126	357	3,241	9,085	12,410	7,637	2,206	160	104	0	0	100
Water Year Types ^c												
Wet (32%)	183	910	8,420	24,291	29,547	18,493	5,627	289	113	0	0	100
Above Normal (16%)	100	100	2,765	5,997	13,013	7,928	1,688	100	100	0	0	100
Below Normal (13%)	100	100	242	1,004	3,031	883	293	100	100	0	0	100
Dry (24%)	100	100	322	902	2,024	1,393	407	100	100	0	0	100
Critical (15%)	100	100	149	528	534	396	106	100	100	0	0	100
Alternative 1												
Statistic	Monthly Spills (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	100	100	10,543	30,193	44,709	18,331	5,859	100	100	0	0	100
20%	100	100	3,673	10,516	13,894	7,379	4,169	100	100	0	0	100
30%	100	100	1,561	5,231	8,342	5,266	966	100	100	0	0	100
40%	100	100	533	2,826	5,470	3,433	341	100	100	0	0	100
50%	100	100	186	1,630	3,269	2,065	119	100	100	0	0	100
60%	100	100	100	851	2,291	1,101	100	100	100	0	0	100
70%	100	100	100	153	1,008	481	100	100	100	0	0	100
80%	100	100	100	100	184	201	100	100	100	0	0	100
90%	100	100	100	100	100	100	100	100	100	0	0	100
Long Term												
Full Simulation Period ^b	115	384	3,697	9,549	13,200	7,942	2,211	160	104	0	0	100
Water Year Types ^c												
Wet (32%)	147	996	9,888	25,442	30,547	18,997	5,602	289	113	0	0	100
Above Normal (16%)	100	100	2,659	6,349	15,114	8,566	1,765	100	100	0	0	100
Below Normal (13%)	100	100	262	1,256	4,057	1,166	292	100	100	0	0	100
Dry (24%)	100	100	342	932	2,032	1,411	411	100	100	0	0	100
Critical (15%)	100	100	149	542	533	408	106	100	100	0	0	100
Alternative 1 minus No Action Alternative												
Statistic	Monthly Spills (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0	0	3,314	6,220	3,920	2,254	23	0	0	0	0	0
20%	0	0	194	105	1,312	749	174	0	0	0	0	0
30%	0	0	341	-15	1,273	735	82	0	0	0	0	0
40%	0	0	26	105	221	-29	1	0	0	0	0	0
50%	0	0	1	218	-36	316	5	0	0	0	0	0
60%	0	0	0	168	118	126	0	0	0	0	0	0
70%	0	0	0	8	76	161	0	0	0	0	0	0
80%	0	0	0	0	-2	25	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	-12	27	456	464	790	305	5	0	0	0	0	0
Water Year Types ^c												
Wet (32%)	-37	86	1,468	1,151	1,000	504	-25	0	0	0	0	0
Above Normal (16%)	0	0	-106	352	2,102	638	77	0	0	0	0	0
Below Normal (13%)	0	0	20	253	1,026	283	-1	0	0	0	0	0
Dry (24%)	0	0	20	30	7	17	4	0	0	0	0	0
Critical (15%)	0	0	1	15	-1	12	0	0	0	0	0	0
a Exceedance probability is defined as the probability a given value will be exceeded in any one year. b Based on the 82-year simulation period. c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.												

Table C-26-2. Fremont Weir, Monthly Spills

No Action Alternative												
Statistic	Monthly Spills (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	100	100	7,229	23,972	40,788	16,077	5,836	100	100	0	0	100
20%	100	100	3,479	10,411	12,582	6,630	3,995	100	100	0	0	100
30%	100	100	1,219	5,246	7,068	4,531	884	100	100	0	0	100
40%	100	100	507	2,721	5,249	3,462	340	100	100	0	0	100
50%	100	100	185	1,412	3,305	1,749	114	100	100	0	0	100
60%	100	100	100	683	2,173	975	100	100	100	0	0	100
70%	100	100	100	145	932	321	100	100	100	0	0	100
80%	100	100	100	100	187	176	100	100	100	0	0	100
90%	100	100	100	100	100	100	100	100	100	0	0	100
Long Term												
Full Simulation Period ^b	126	357	3,241	9,085	12,410	7,637	2,206	160	104	0	0	100
Water Year Types ^c												
Wet (32%)	183	910	8,420	24,291	29,547	18,493	5,627	289	113	0	0	100
Above Normal (16%)	100	100	2,765	5,997	13,013	7,928	1,688	100	100	0	0	100
Below Normal (13%)	100	100	242	1,004	3,031	883	293	100	100	0	0	100
Dry (24%)	100	100	322	902	2,024	1,393	407	100	100	0	0	100
Critical (15%)	100	100	149	528	534	396	106	100	100	0	0	100

Alternative 3												
Statistic	Monthly Spills (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	100	100	10,562	27,452	43,972	18,326	5,842	100	100	0	0	100
20%	100	100	3,657	10,624	13,753	6,816	4,163	100	100	0	0	100
30%	100	100	1,554	5,215	8,000	4,697	961	100	100	0	0	100
40%	100	100	535	2,831	5,471	3,406	341	100	100	0	0	100
50%	100	100	215	1,519	3,328	2,006	114	100	100	0	0	100
60%	100	100	100	789	2,202	1,123	100	100	100	0	0	100
70%	100	100	100	152	1,089	440	100	100	100	0	0	100
80%	100	100	100	100	203	179	100	100	100	0	0	100
90%	100	100	100	100	100	100	100	100	100	0	0	100
Long Term												
Full Simulation Period ^b	112	377	3,640	9,456	13,036	7,875	2,216	160	104	0	0	100
Water Year Types ^c												
Wet (32%)	139	973	9,693	25,241	30,361	18,837	5,617	289	113	0	0	100
Above Normal (16%)	100	100	2,686	6,188	14,531	8,490	1,768	100	100	0	0	100
Below Normal (13%)	100	100	262	1,250	4,001	1,153	293	100	100	0	0	100
Dry (24%)	100	100	342	923	2,007	1,406	410	100	100	0	0	100
Critical (15%)	100	100	150	534	545	397	106	100	100	0	0	100

Alternative 3 minus No Action Alternative												
Statistic	Monthly Spills (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0	0	3,333	3,480	3,184	2,249	6	0	0	0	0	0
20%	0	0	178	213	1,170	186	168	0	0	0	0	0
30%	0	0	335	-32	932	166	78	0	0	0	0	0
40%	0	0	28	110	221	-55	2	0	0	0	0	0
50%	0	0	29	107	23	256	0	0	0	0	0	0
60%	0	0	0	106	29	147	0	0	0	0	0	0
70%	0	0	0	7	157	119	0	0	0	0	0	0
80%	0	0	0	0	16	3	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	-14	20	399	371	626	238	10	0	0	0	0	0
Water Year Types ^c												
Wet (32%)	-45	64	1,273	950	813	344	-10	1	0	0	0	0
Above Normal (16%)	0	0	-78	192	1,519	562	80	0	0	0	0	0
Below Normal (13%)	0	0	20	247	970	271	-1	0	0	0	0	0
Dry (24%)	0	0	19	22	-17	13	3	0	0	0	0	0
Critical (15%)	0	0	1	7	11	1	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-26-3. Fremont Weir, Monthly Spills

No Action Alternative												
Statistic	Monthly Spills (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	100	100	7,229	23,972	40,788	16,077	5,836	100	100	0	0	100
20%	100	100	3,479	10,411	12,582	6,630	3,995	100	100	0	0	100
30%	100	100	1,219	5,246	7,068	4,531	884	100	100	0	0	100
40%	100	100	507	2,721	5,249	3,462	340	100	100	0	0	100
50%	100	100	185	1,412	3,305	1,749	114	100	100	0	0	100
60%	100	100	100	683	2,173	975	100	100	100	0	0	100
70%	100	100	100	145	932	321	100	100	100	0	0	100
80%	100	100	100	100	187	176	100	100	100	0	0	100
90%	100	100	100	100	100	100	100	100	100	0	0	100
Long Term												
Full Simulation Period ^b	126	357	3,241	9,085	12,410	7,637	2,206	160	104	0	0	100
Water Year Types ^c												
Wet (32%)	183	910	8,420	24,291	29,547	18,493	5,627	289	113	0	0	100
Above Normal (16%)	100	100	2,765	5,997	13,013	7,928	1,688	100	100	0	0	100
Below Normal (13%)	100	100	242	1,004	3,031	883	293	100	100	0	0	100
Dry (24%)	100	100	322	902	2,024	1,393	407	100	100	0	0	100
Critical (15%)	100	100	149	528	534	396	106	100	100	0	0	100

Alternative 5												
Statistic	Monthly Spills (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	100	100	7,431	23,953	40,288	16,133	5,836	100	100	0	0	100
20%	100	100	3,445	10,420	12,539	6,538	3,992	100	100	0	0	100
30%	100	100	1,217	5,246	7,057	4,576	884	100	100	0	0	100
40%	100	100	507	2,676	5,250	3,467	341	100	100	0	0	100
50%	100	100	198	1,412	3,305	1,717	114	100	100	0	0	100
60%	100	100	100	683	2,148	963	100	100	100	0	0	100
70%	100	100	100	144	932	336	100	100	100	0	0	100
80%	100	100	100	100	187	176	100	100	100	0	0	100
90%	100	100	100	100	100	100	100	100	100	0	0	100
Long Term												
Full Simulation Period ^b	122	364	3,237	9,006	12,386	7,638	2,206	160	104	0	0	100
Water Year Types ^c												
Wet (32%)	170	933	8,400	24,048	29,507	18,512	5,627	289	113	0	0	100
Above Normal (16%)	100	100	2,786	6,000	12,885	7,895	1,688	100	100	0	0	100
Below Normal (13%)	100	100	242	1,004	3,115	886	293	100	100	0	0	100
Dry (24%)	100	100	317	896	2,015	1,398	407	100	100	0	0	100
Critical (15%)	100	100	151	525	531	393	106	100	100	0	0	100

Alternative 5 minus No Action Alternative												
Statistic	Monthly Spills (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0	0	202	-19	-501	56	0	0	0	0	0	0
20%	0	0	-34	10	-43	-92	-3	0	0	0	0	0
30%	0	0	-2	-1	-11	45	0	0	0	0	0	0
40%	0	0	0	-44	1	6	1	0	0	0	0	0
50%	0	0	13	0	0	-32	0	0	0	0	0	0
60%	0	0	0	0	-25	-12	0	0	0	0	0	0
70%	0	0	0	-1	0	15	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	-4	7	-4	-78	-24	2	0	0	0	0	0	0
Water Year Types ^c												
Wet (32%)	-13	23	-20	-243	-40	18	0	0	0	0	0	0
Above Normal (16%)	0	0	22	4	-128	-34	0	0	0	0	0	0
Below Normal (13%)	0	0	-1	0	84	3	0	0	0	0	0	0
Dry (24%)	0	0	-5	-6	-10	4	0	0	0	0	0	0
Critical (15%)	0	0	2	-3	-3	-3	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-26-4. Fremont Weir, Monthly Spills

Second Basis of Comparison

Statistic	Monthly Spills (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	10,543	30,193	44,709	18,331	5,859	100	100	0	0	100
20%	100	100	3,673	10,516	13,894	7,379	4,169	100	100	0	0	100
30%	100	100	1,561	5,231	8,342	5,266	966	100	100	0	0	100
40%	100	100	533	2,826	5,470	3,433	341	100	100	0	0	100
50%	100	100	186	1,630	3,269	2,065	119	100	100	0	0	100
60%	100	100	100	851	2,291	1,101	100	100	100	0	0	100
70%	100	100	100	153	1,008	481	100	100	100	0	0	100
80%	100	100	100	100	184	201	100	100	100	0	0	100
90%	100	100	100	100	100	100	100	100	100	0	0	100
Long Term												
Full Simulation Period ^b	115	384	3,697	9,549	13,200	7,942	2,211	160	104	0	0	100
Water Year Types^c												
Wet (32%)	147	996	9,888	25,442	30,547	18,997	5,602	289	113	0	0	100
Above Normal (16%)	100	100	2,659	6,349	15,114	8,566	1,765	100	100	0	0	100
Below Normal (13%)	100	100	262	1,256	4,057	1,166	292	100	100	0	0	100
Dry (24%)	100	100	342	932	2,032	1,411	411	100	100	0	0	100
Critical (15%)	100	100	149	542	533	408	106	100	100	0	0	100

No Action Alternative

Statistic	Monthly Spills (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	7,229	23,972	40,788	16,077	5,836	100	100	0	0	100
20%	100	100	3,479	10,411	12,582	6,630	3,995	100	100	0	0	100
30%	100	100	1,219	5,246	7,068	4,531	884	100	100	0	0	100
40%	100	100	507	2,721	5,249	3,462	340	100	100	0	0	100
50%	100	100	185	1,412	3,305	1,749	114	100	100	0	0	100
60%	100	100	100	683	2,173	975	100	100	100	0	0	100
70%	100	100	100	145	932	321	100	100	100	0	0	100
80%	100	100	100	100	187	176	100	100	100	0	0	100
90%	100	100	100	100	100	100	100	100	100	0	0	100
Long Term												
Full Simulation Period ^b	126	357	3,241	9,085	12,410	7,637	2,206	160	104	0	0	100
Water Year Types^c												
Wet (32%)	183	910	8,420	24,291	29,547	18,493	5,627	289	113	0	0	100
Above Normal (16%)	100	100	2,765	5,997	13,013	7,928	1,688	100	100	0	0	100
Below Normal (13%)	100	100	242	1,004	3,031	883	293	100	100	0	0	100
Dry (24%)	100	100	322	902	2,024	1,393	407	100	100	0	0	100
Critical (15%)	100	100	149	528	534	396	106	100	100	0	0	100

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Spills (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	-3,314	-6,220	-3,920	-2,254	-23	0	0	0	0	0
20%	0	0	-194	-105	-1,312	-749	-174	0	0	0	0	0
30%	0	0	-341	15	-1,273	-735	-82	0	0	0	0	0
40%	0	0	-26	-105	-221	29	-1	0	0	0	0	0
50%	0	0	-1	-218	36	-316	-5	0	0	0	0	0
60%	0	0	0	-168	-118	-126	0	0	0	0	0	0
70%	0	0	0	-8	-76	-161	0	0	0	0	0	0
80%	0	0	0	0	2	-25	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	12	-27	-456	-464	-790	-305	-5	0	0	0	0	0
Water Year Types^c												
Wet (32%)	37	-86	-1,468	-1,151	-1,000	-504	25	0	0	0	0	0
Above Normal (16%)	0	0	106	-352	-2,102	-638	-77	0	0	0	0	0
Below Normal (13%)	0	0	-20	-253	-1,026	-283	1	0	0	0	0	0
Dry (24%)	0	0	-20	-30	-7	-17	-4	0	0	0	0	0
Critical (15%)	0	0	-1	-15	1	-12	0	0	0	0	0	0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-26-5. Fremont Weir, Monthly Spills

Second Basis of Comparison

Statistic	Monthly Spills (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	100	100	10,543	30,193	44,709	18,331	5,859	100	100	0	0	100
20%	100	100	3,673	10,516	13,894	7,379	4,169	100	100	0	0	100
30%	100	100	1,561	5,231	8,342	5,266	966	100	100	0	0	100
40%	100	100	533	2,826	5,470	3,433	341	100	100	0	0	100
50%	100	100	186	1,630	3,269	2,065	119	100	100	0	0	100
60%	100	100	100	851	2,291	1,101	100	100	100	0	0	100
70%	100	100	100	153	1,008	481	100	100	100	0	0	100
80%	100	100	100	100	184	201	100	100	100	0	0	100
90%	100	100	100	100	100	100	100	100	100	0	0	100
Long Term												
Full Simulation Period ^b	115	384	3,697	9,549	13,200	7,942	2,211	160	104	0	0	100
Water Year Types ^c												
Wet (32%)	147	996	9,888	25,442	30,547	18,997	5,602	289	113	0	0	100
Above Normal (16%)	100	100	2,659	6,349	15,114	8,566	1,765	100	100	0	0	100
Below Normal (13%)	100	100	262	1,256	4,057	1,166	292	100	100	0	0	100
Dry (24%)	100	100	342	932	2,032	1,411	411	100	100	0	0	100
Critical (15%)	100	100	149	542	533	408	106	100	100	0	0	100

Alternative 3

Statistic	Monthly Spills (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	100	100	10,562	27,452	43,972	18,326	5,842	100	100	0	0	100
20%	100	100	3,657	10,624	13,753	6,816	4,163	100	100	0	0	100
30%	100	100	1,554	5,215	8,000	4,697	961	100	100	0	0	100
40%	100	100	535	2,831	5,471	3,406	341	100	100	0	0	100
50%	100	100	215	1,519	3,328	2,006	114	100	100	0	0	100
60%	100	100	100	789	2,202	1,123	100	100	100	0	0	100
70%	100	100	100	152	1,089	440	100	100	100	0	0	100
80%	100	100	100	100	203	179	100	100	100	0	0	100
90%	100	100	100	100	100	100	100	100	100	0	0	100
Long Term												
Full Simulation Period ^b	112	377	3,640	9,456	13,036	7,875	2,216	160	104	0	0	100
Water Year Types ^c												
Wet (32%)	139	973	9,693	25,241	30,361	18,837	5,617	289	113	0	0	100
Above Normal (16%)	100	100	2,686	6,188	14,531	8,490	1,768	100	100	0	0	100
Below Normal (13%)	100	100	262	1,250	4,001	1,153	293	100	100	0	0	100
Dry (24%)	100	100	342	923	2,007	1,406	410	100	100	0	0	100
Critical (15%)	100	100	150	534	545	397	106	100	100	0	0	100

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Spills (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0	0	19	-2,740	-736	-5	-17	0	0	0	0	0
20%	0	0	-16	108	-141	-563	-7	0	0	0	0	0
30%	0	0	-6	-16	-342	-569	-5	0	0	0	0	0
40%	0	0	2	5	1	-26	1	0	0	0	0	0
50%	0	0	29	-111	59	-59	-5	0	0	0	0	0
60%	0	0	0	-61	-89	22	0	0	0	0	0	0
70%	0	0	0	-1	81	-42	0	0	0	0	0	0
80%	0	0	0	0	19	-21	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	-3	-7	-58	-93	-163	-67	5	0	0	0	0	0
Water Year Types ^c												
Wet (32%)	-8	-23	-195	-201	-187	-160	15	0	0	0	0	0
Above Normal (16%)	0	0	28	-161	-583	-76	4	0	0	0	0	0
Below Normal (13%)	0	0	0	-6	-56	-13	0	0	0	0	0	0
Dry (24%)	0	0	-1	-9	-24	-4	-2	0	0	0	0	0
Critical (15%)	0	0	0	-8	12	-11	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-26-6. Fremont Weir, Monthly Spills

Second Basis of Comparison

Statistic	Monthly Spills (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	100	100	10,543	30,193	44,709	18,331	5,859	100	100	0	0	100
20%	100	100	3,673	10,516	13,894	7,379	4,169	100	100	0	0	100
30%	100	100	1,561	5,231	8,342	5,266	966	100	100	0	0	100
40%	100	100	533	2,826	5,470	3,433	341	100	100	0	0	100
50%	100	100	186	1,630	3,269	2,065	119	100	100	0	0	100
60%	100	100	100	851	2,291	1,101	100	100	100	0	0	100
70%	100	100	100	153	1,008	481	100	100	100	0	0	100
80%	100	100	100	100	184	201	100	100	100	0	0	100
90%	100	100	100	100	100	100	100	100	100	0	0	100
Long Term												
Full Simulation Period ^b	115	384	3,697	9,549	13,200	7,942	2,211	160	104	0	0	100
Water Year Types ^c												
Wet (32%)	147	996	9,888	25,442	30,547	18,997	5,602	289	113	0	0	100
Above Normal (16%)	100	100	2,659	6,349	15,114	8,566	1,765	100	100	0	0	100
Below Normal (13%)	100	100	262	1,256	4,057	1,166	292	100	100	0	0	100
Dry (24%)	100	100	342	932	2,032	1,411	411	100	100	0	0	100
Critical (15%)	100	100	149	542	533	408	106	100	100	0	0	100

Alternative 5

Statistic	Monthly Spills (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	100	100	7,431	23,953	40,288	16,133	5,836	100	100	0	0	100
20%	100	100	3,445	10,420	12,539	6,538	3,992	100	100	0	0	100
30%	100	100	1,217	5,246	7,057	4,576	884	100	100	0	0	100
40%	100	100	507	2,676	5,250	3,467	341	100	100	0	0	100
50%	100	100	198	1,412	3,305	1,717	114	100	100	0	0	100
60%	100	100	100	683	2,148	963	100	100	100	0	0	100
70%	100	100	100	144	932	336	100	100	100	0	0	100
80%	100	100	100	100	187	176	100	100	100	0	0	100
90%	100	100	100	100	100	100	100	100	100	0	0	100
Long Term												
Full Simulation Period ^b	122	364	3,237	9,006	12,386	7,638	2,206	160	104	0	0	100
Water Year Types ^c												
Wet (32%)	170	933	8,400	24,048	29,507	18,512	5,627	289	113	0	0	100
Above Normal (16%)	100	100	2,786	6,000	12,885	7,895	1,688	100	100	0	0	100
Below Normal (13%)	100	100	242	1,004	3,115	886	293	100	100	0	0	100
Dry (24%)	100	100	317	896	2,015	1,398	407	100	100	0	0	100
Critical (15%)	100	100	151	525	531	393	106	100	100	0	0	100

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Spills (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0	0	-3,112	-6,239	-4,421	-2,197	-23	0	0	0	0	0
20%	0	0	-228	-96	-1,355	-841	-177	0	0	0	0	0
30%	0	0	-343	15	-1,284	-690	-82	0	0	0	0	0
40%	0	0	-26	-149	-220	34	0	0	0	0	0	0
50%	0	0	12	-219	36	-347	-5	0	0	0	0	0
60%	0	0	0	-168	-143	-138	0	0	0	0	0	0
70%	0	0	0	-9	-76	-145	0	0	0	0	0	0
80%	0	0	0	0	2	-25	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	7	-20	-460	-542	-814	-303	-5	0	0	0	0	0
Water Year Types ^c												
Wet (32%)	23	-63	-1,488	-1,394	-1,040	-486	25	0	0	0	0	0
Above Normal (16%)	0	0	128	-349	-2,230	-671	-77	0	0	0	0	0
Below Normal (13%)	0	0	-20	-252	-942	-280	1	0	0	0	0	0
Dry (24%)	0	0	-25	-36	-17	-13	-4	0	0	0	0	0
Critical (15%)	0	0	2	-17	-2	-15	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1 **C.27. American River Flow downstream of Nimbus**


Figure C-27-1. American River d/s of Nimbus Dam, Long-Term* Average Flow

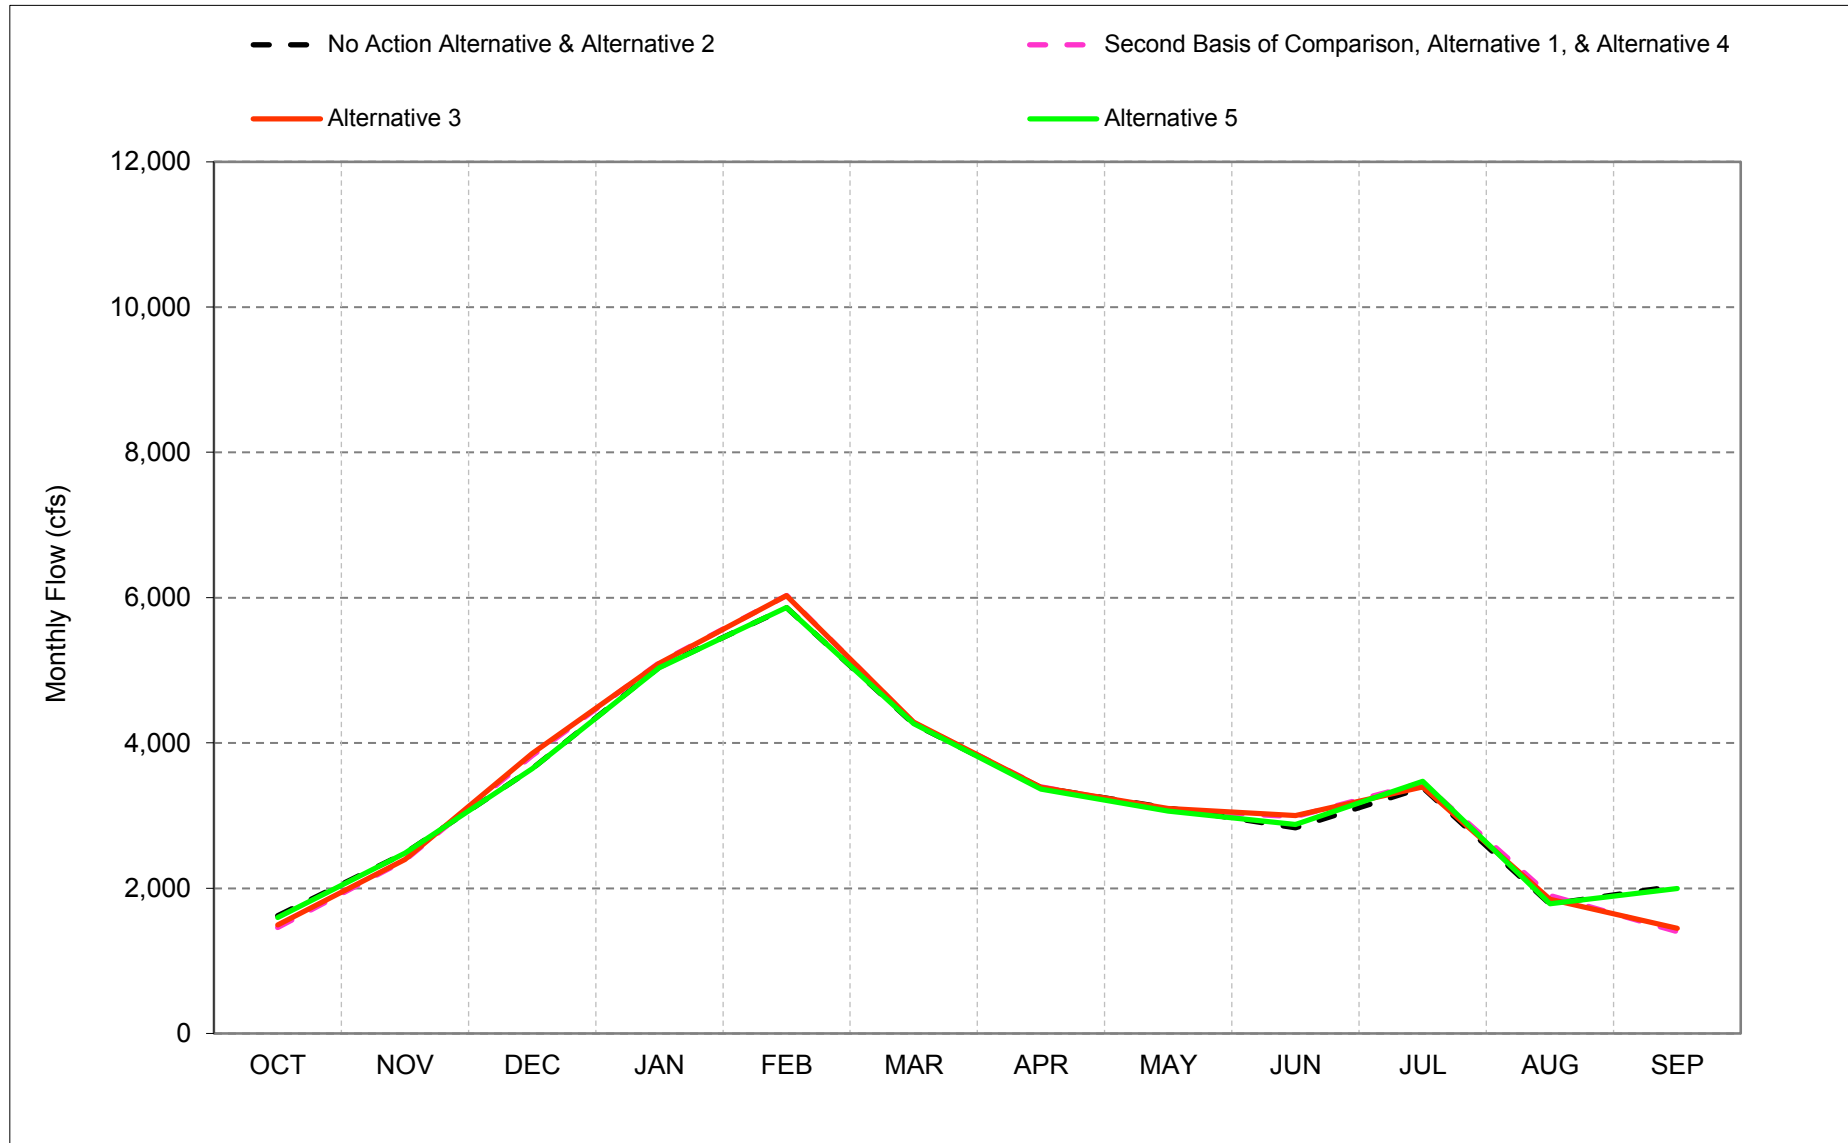

*Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-27-2. American River d/s of Nimbus Dam, Wet Year* Long-Term** Average Flow

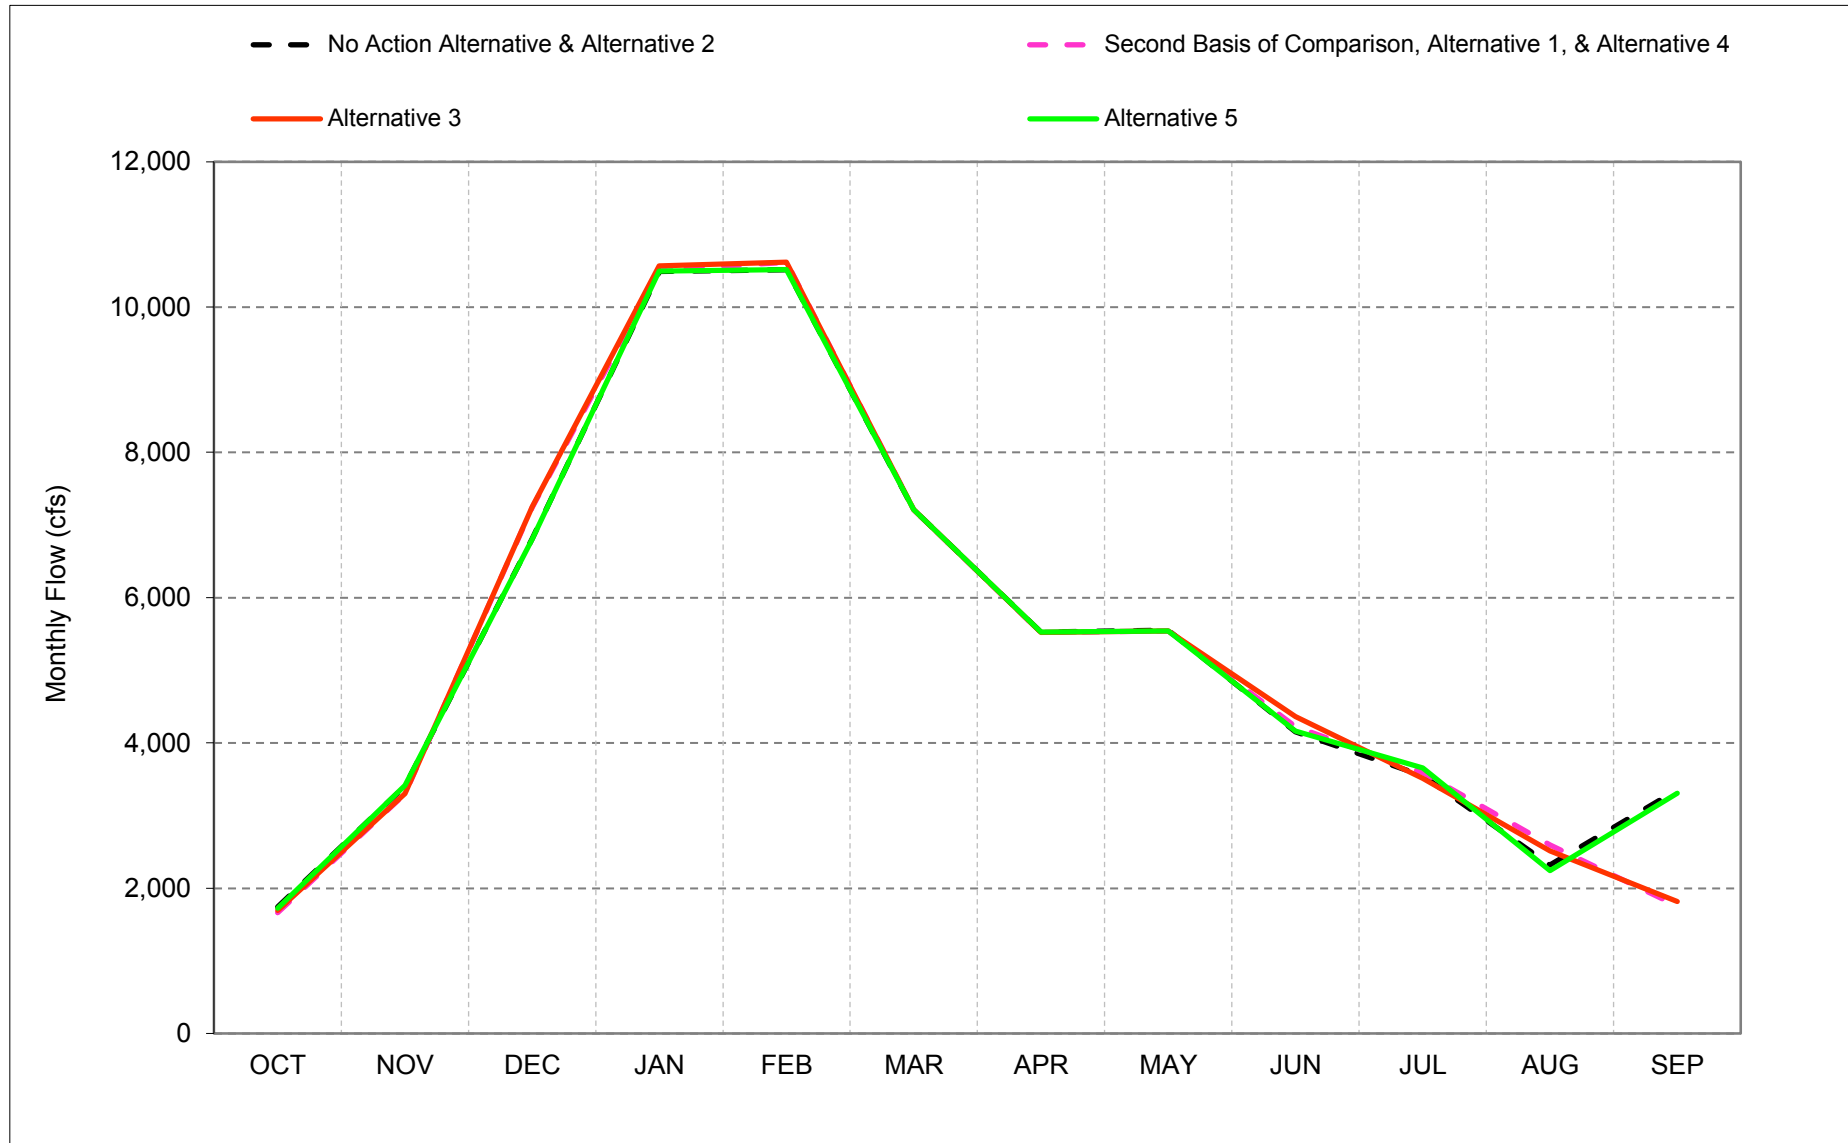


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-27-3. American River d/s of Nimbus Dam, Above Normal Year* Long-Term Average Flow**

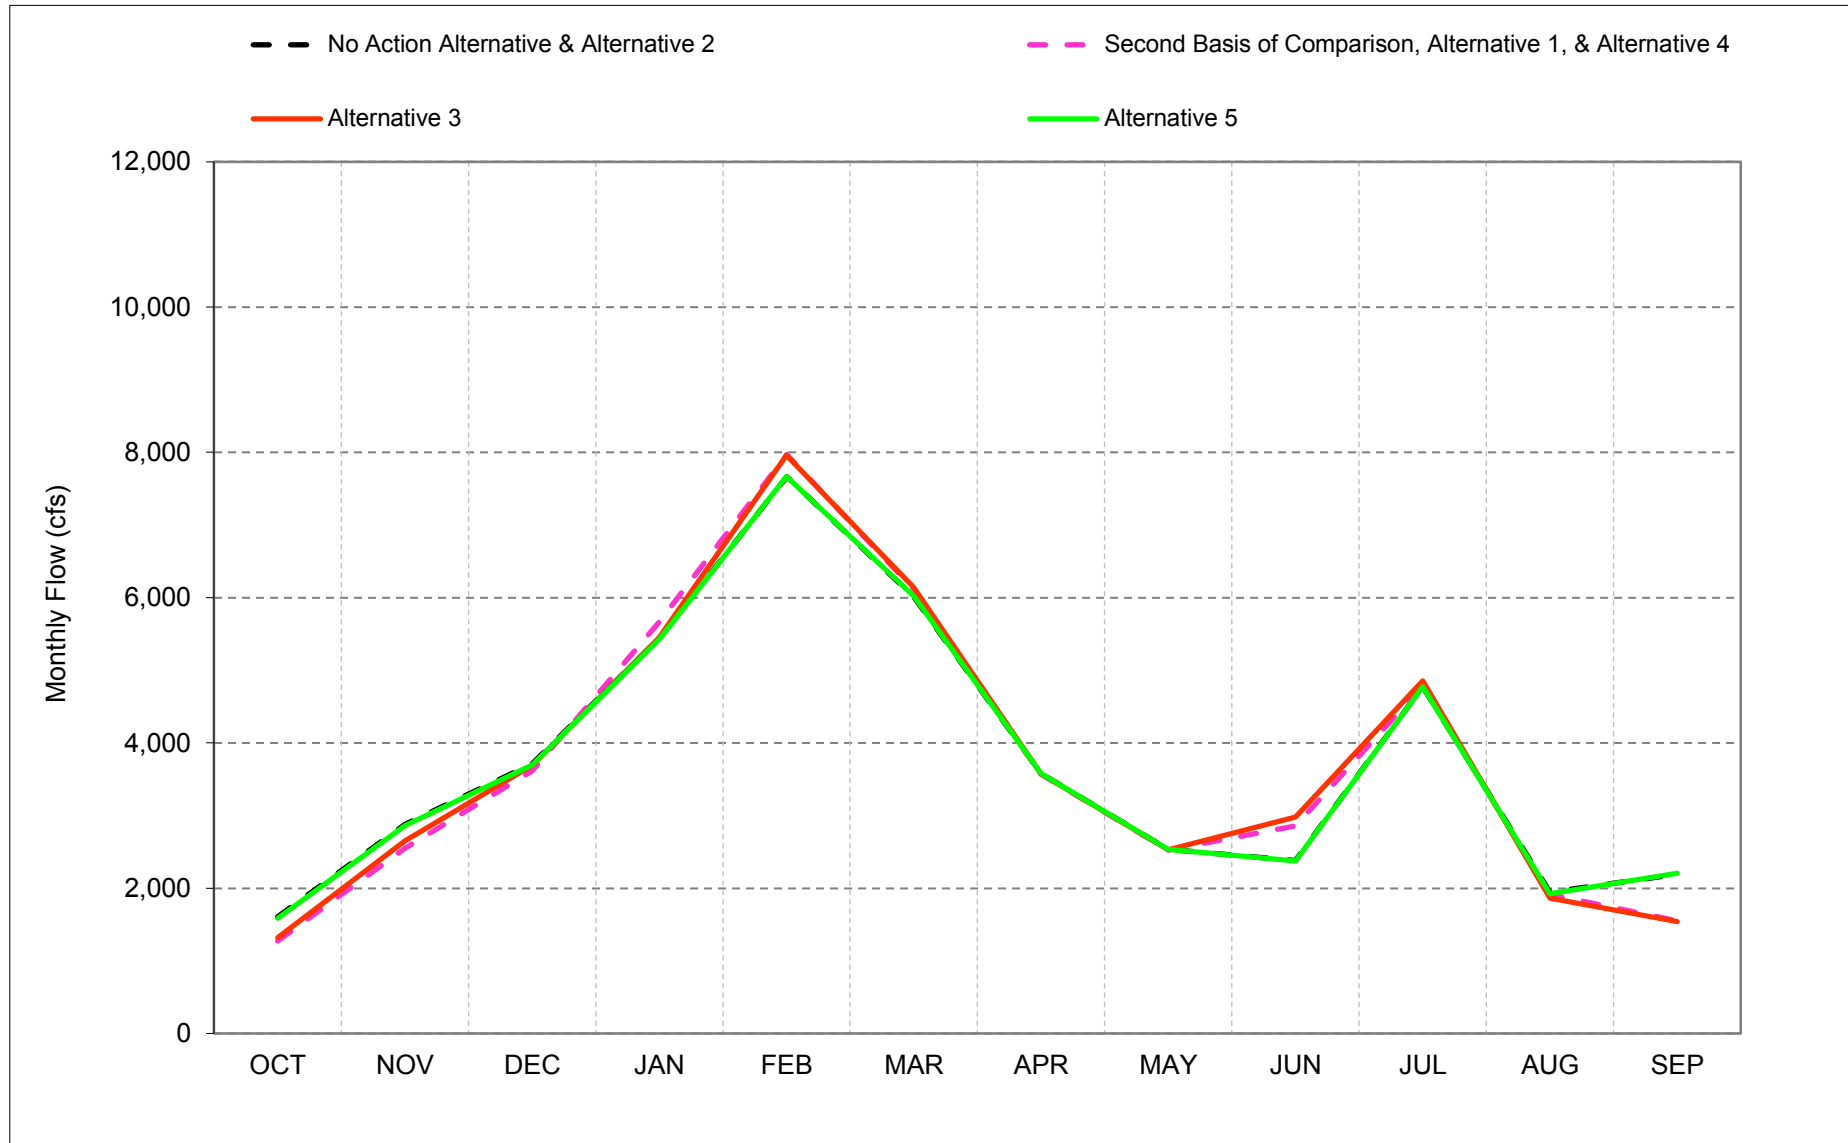


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-27-4. American River d/s of Nimbus Dam, Below Normal Year* Long-Term** Average Flow

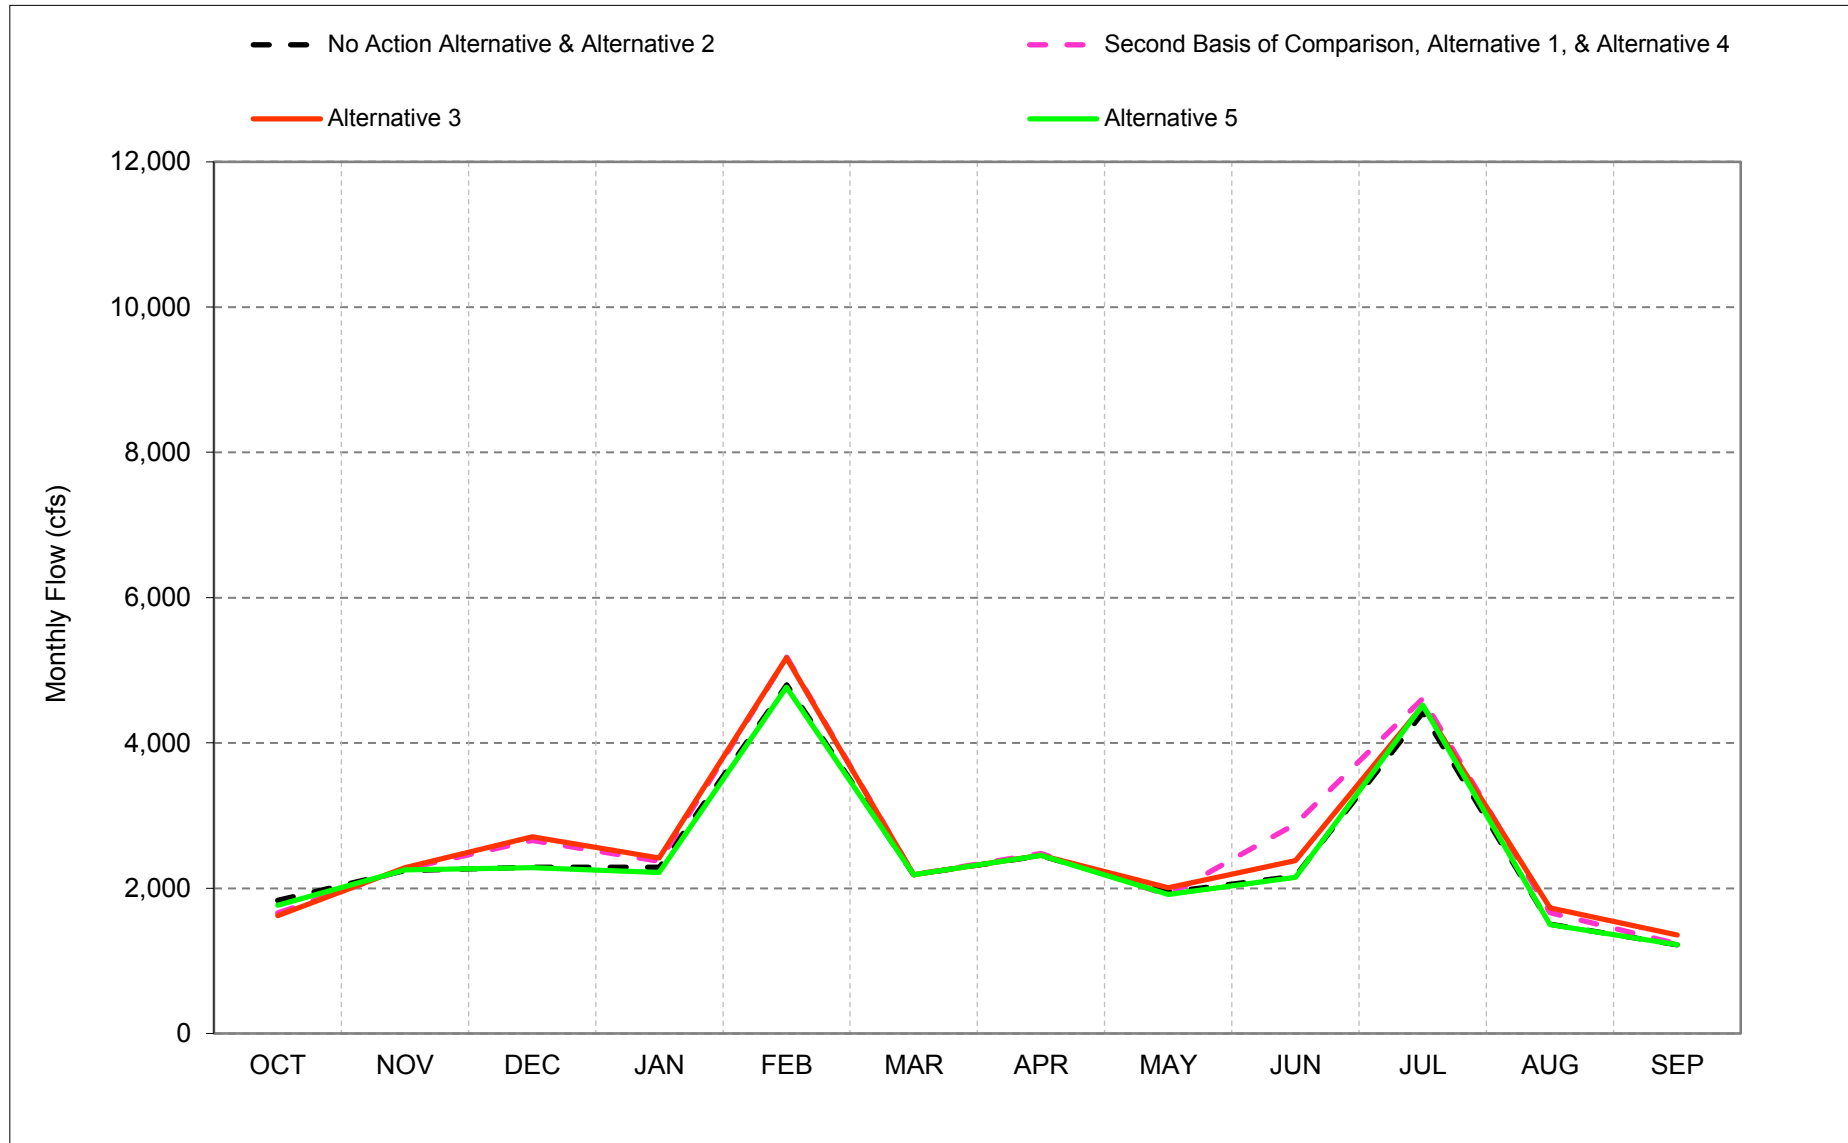


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-27-5. American River d/s of Nimbus Dam, Dry Year* Long-Term** Average Flow

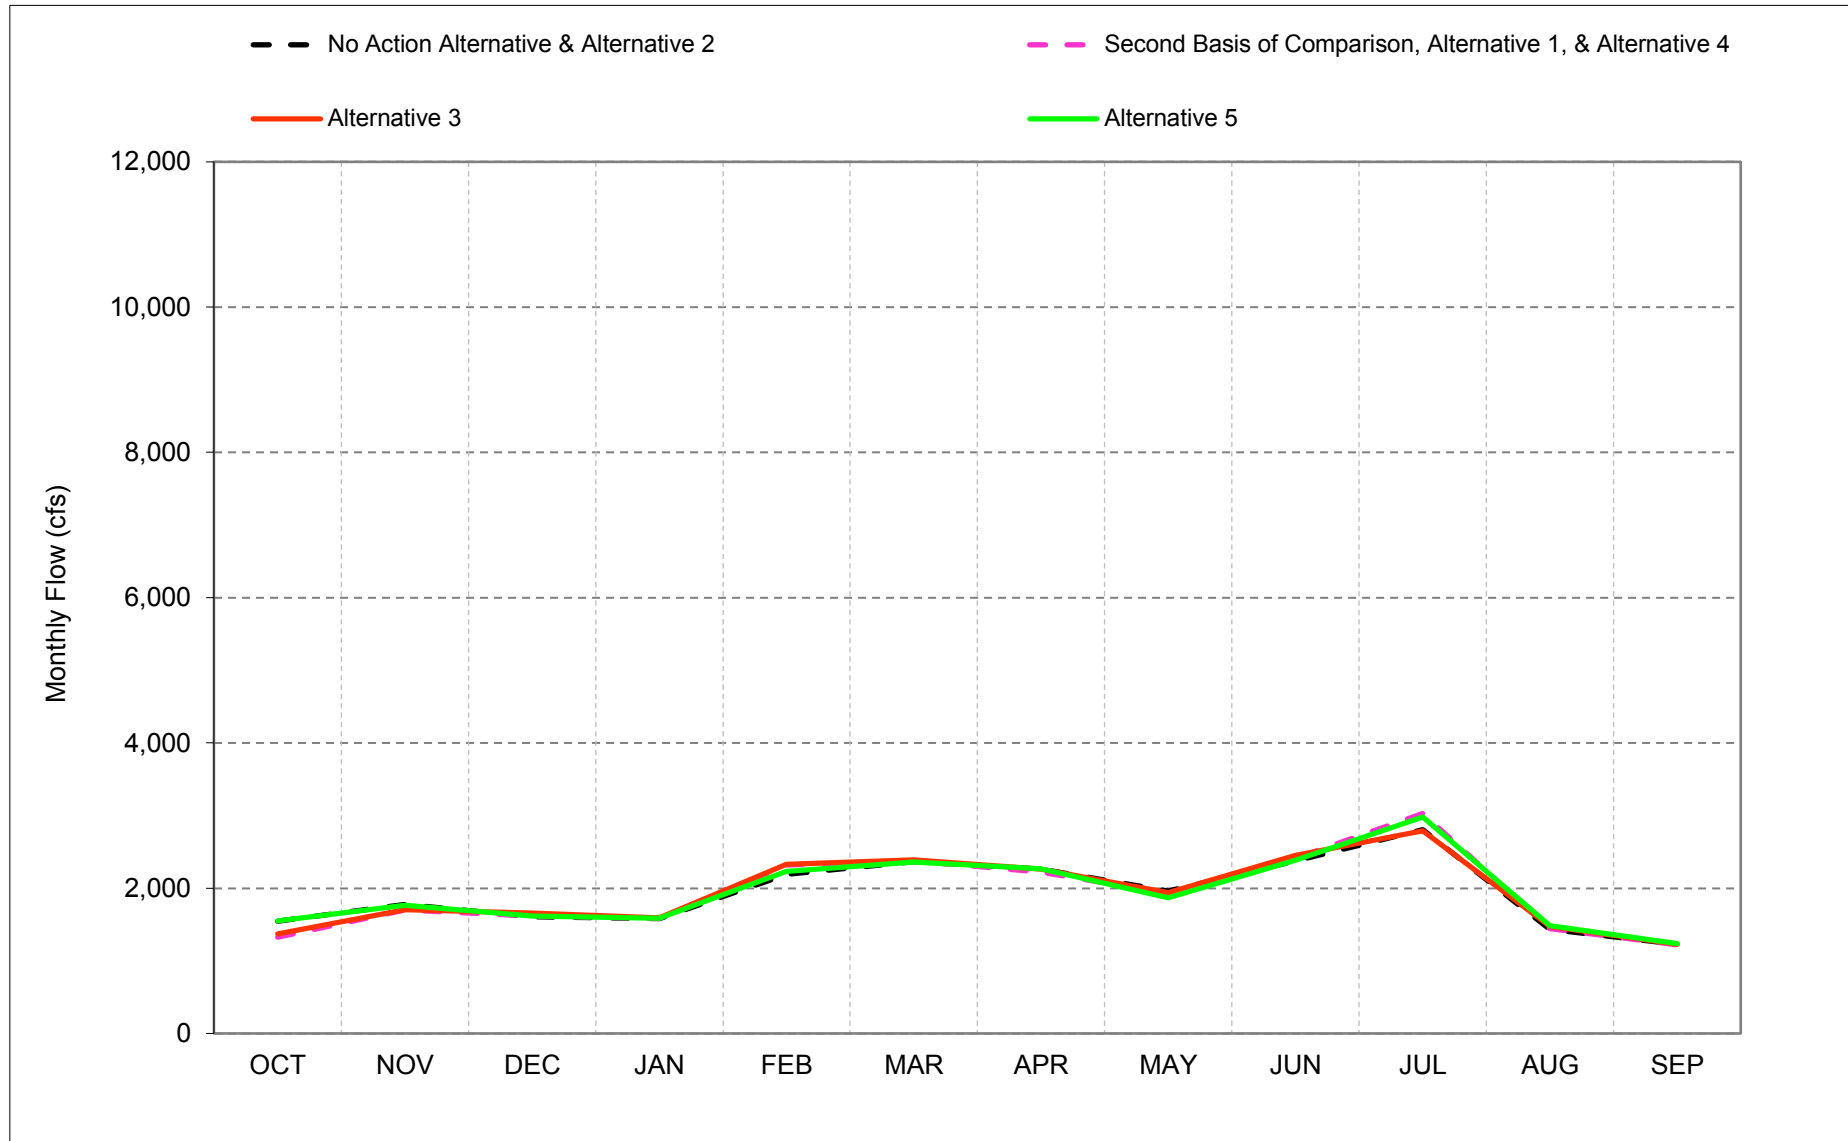


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-27-6. American River d/s of Nimbus Dam, Critical Year* Long-Term** Average Flow

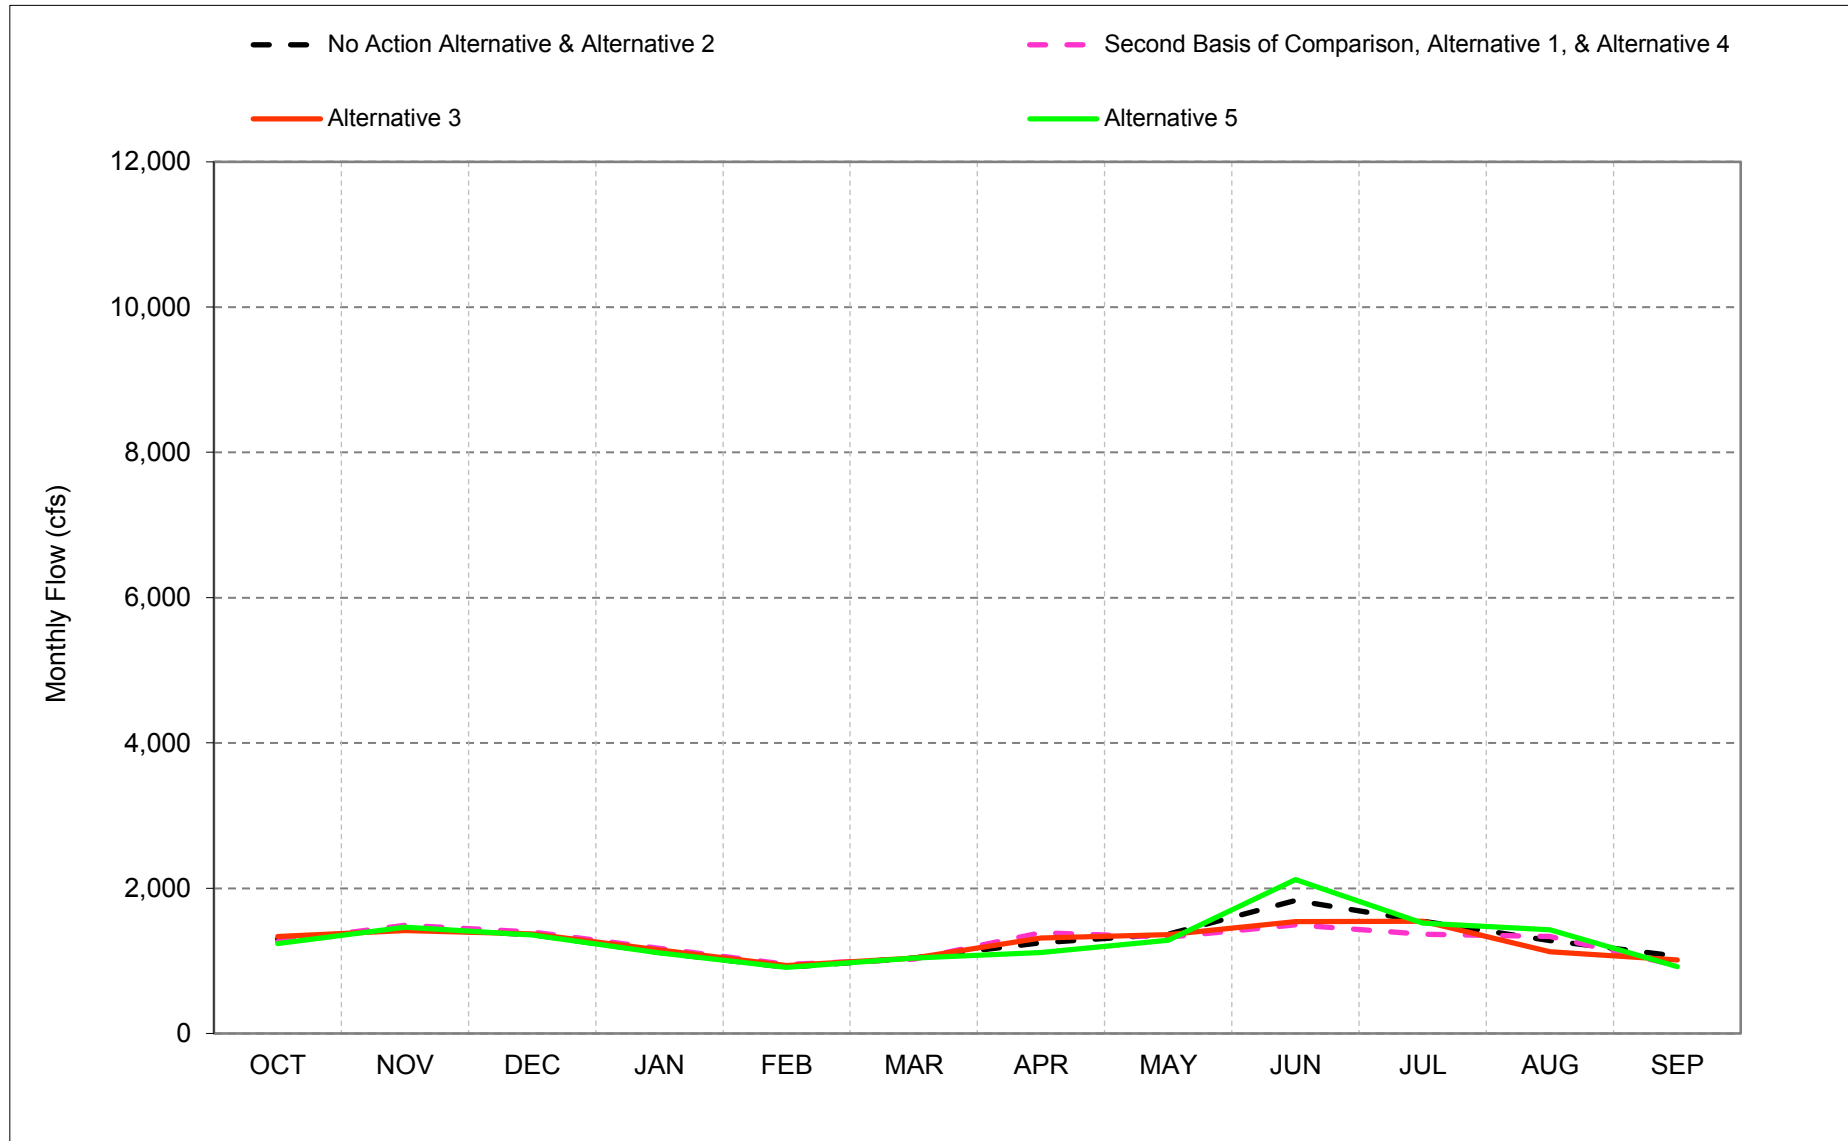

*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-27-1. American River d/s of Nimbus Dam, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	2,600	3,783	8,379	12,160	14,655	9,756	6,737	7,450	4,753	5,000	3,083	3,957
20%	1,962	3,343	3,880	7,656	10,890	6,820	5,085	4,489	3,837	5,000	2,265	3,182
30%	1,639	2,565	2,076	5,303	7,117	5,044	4,494	3,543	3,507	4,916	1,967	2,426
40%	1,500	1,981	2,000	3,583	5,759	4,176	3,491	2,861	2,722	3,856	1,768	1,932
50%	1,500	1,925	2,000	1,750	3,087	3,057	2,544	2,268	2,293	3,567	1,750	1,565
60%	1,500	1,683	1,845	1,700	1,796	2,022	2,111	1,750	1,951	2,854	1,750	1,533
70%	1,500	1,515	1,595	1,700	1,445	1,747	1,747	1,609	1,750	2,510	1,630	1,480
80%	1,182	1,226	1,368	1,362	1,264	854	1,021	1,119	1,401	2,350	895	808
90%	800	800	800	985	901	800	800	800	904	1,137	800	800
Long Term												
Full Simulation Period ^b	1,622	2,483	3,648	5,045	5,861	4,263	3,384	3,103	2,833	3,385	1,783	2,031
Water Year Types ^c												
Wet (32%)	1,743	3,407	6,812	10,489	10,512	7,212	5,524	5,554	4,155	3,549	2,319	3,356
Above Normal (16%)	1,607	2,879	3,712	5,445	7,665	6,015	3,579	2,534	2,383	4,775	1,946	2,193
Below Normal (13%)	1,834	2,246	2,291	2,288	4,800	2,188	2,451	1,946	2,168	4,416	1,508	1,222
Dry (24%)	1,547	1,778	1,608	1,582	2,193	2,366	2,266	1,962	2,375	2,806	1,432	1,230
Critical (15%)	1,303	1,443	1,365	1,114	914	1,042	1,251	1,369	1,832	1,545	1,280	1,064
Alternative 1												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1,967	3,834	9,336	12,160	14,655	9,754	6,737	7,450	4,650	5,000	3,236	1,837
20%	1,500	3,218	4,325	7,873	10,806	6,805	5,083	4,486	3,799	5,000	2,678	1,604
30%	1,500	2,070	2,528	5,813	7,391	5,044	4,483	3,543	3,623	4,957	2,299	1,533
40%	1,500	1,925	2,000	3,587	5,755	4,172	3,491	2,836	3,223	4,250	1,912	1,533
50%	1,500	1,818	2,000	1,776	3,753	3,039	2,499	2,021	2,835	3,591	1,750	1,533
60%	1,500	1,683	1,936	1,700	2,602	2,015	2,089	1,750	2,245	2,935	1,750	1,533
70%	1,449	1,500	1,701	1,700	1,445	1,747	1,750	1,625	1,832	2,589	1,681	1,493
80%	991	1,136	1,146	1,440	1,264	921	1,162	1,074	1,727	2,373	957	800
90%	800	800	800	819	1,032	800	800	800	1,061	1,327	800	780
Long Term												
Full Simulation Period ^b	1,461	2,386	3,826	5,109	6,030	4,279	3,395	3,077	2,987	3,454	1,899	1,404
Water Year Types ^c												
Wet (32%)	1,664	3,300	7,242	10,514	10,615	7,209	5,521	5,541	4,226	3,591	2,597	1,756
Above Normal (16%)	1,274	2,549	3,614	5,670	7,969	6,116	3,572	2,527	2,860	4,782	1,913	1,553
Below Normal (13%)	1,661	2,262	2,660	2,370	5,181	2,187	2,477	1,907	2,881	4,610	1,666	1,236
Dry (24%)	1,329	1,698	1,619	1,587	2,322	2,377	2,222	1,925	2,413	3,028	1,446	1,222
Critical (15%)	1,263	1,492	1,400	1,171	951	1,027	1,391	1,327	1,496	1,368	1,336	935
Alternative 1 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-633	52	957	0	0	-2	0	0	-103	0	152	-2,120
20%	-462	-125	444	217	-84	-15	-1	-3	-38	0	413	-1,579
30%	-139	-495	452	510	274	-1	-11	0	116	41	333	-893
40%	0	-56	0	4	-3	-4	0	-26	501	394	145	-399
50%	0	-107	0	26	665	-18	-45	-247	541	24	0	-32
60%	0	0	91	0	806	-7	-22	0	294	82	0	0
70%	-51	-15	107	0	0	0	3	16	82	79	51	13
80%	-191	-90	-222	78	0	67	141	-45	326	23	62	-8
90%	0	0	0	-166	132	0	0	0	156	190	0	-20
Long Term												
Full Simulation Period ^b	-160	-96	178	64	169	15	11	-26	154	69	116	-628
Water Year Types ^c												
Wet (32%)	-79	-107	430	25	102	-3	-3	-13	72	42	278	-1,600
Above Normal (16%)	-332	-330	-98	225	304	101	-8	-7	477	6	-33	-640
Below Normal (13%)	-173	17	369	82	381	-1	27	-39	713	194	159	14
Dry (24%)	-219	-80	11	5	128	12	-43	-38	37	222	14	-8
Critical (15%)	-40	49	35	56	38	-15	140	-42	-336	-177	56	-129
<p>^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.</p> <p>^b Based on the 82-year simulation period.</p> <p>^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.</p> <p>Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.</p>												

Table C-27-2. American River d/s of Nimbus Dam, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,600	3,783	8,379	12,160	14,655	9,756	6,737	7,450	4,753	5,000	3,083	3,957
20%	1,962	3,343	3,880	7,656	10,890	6,820	5,085	4,489	3,837	5,000	2,265	3,182
30%	1,639	2,565	2,076	5,303	7,117	5,044	4,494	3,543	3,507	4,916	1,967	2,426
40%	1,500	1,981	2,000	3,583	5,759	4,176	3,491	2,861	2,722	3,856	1,768	1,932
50%	1,500	1,925	2,000	1,750	3,087	3,057	2,544	2,268	2,293	3,567	1,750	1,565
60%	1,500	1,683	1,845	1,700	1,796	2,022	2,111	1,750	1,951	2,854	1,750	1,533
70%	1,500	1,515	1,595	1,700	1,445	1,747	1,747	1,609	1,750	2,510	1,630	1,480
80%	1,182	1,226	1,368	1,362	1,264	854	1,021	1,119	1,401	2,350	895	808
90%	800	800	800	985	901	800	800	800	904	1,137	800	800
Long Term												
Full Simulation Period ^b	1,622	2,483	3,648	5,045	5,861	4,263	3,384	3,103	2,833	3,385	1,783	2,031
Water Year Types^c												
Wet (32%)	1,743	3,407	6,812	10,489	10,512	7,212	5,524	5,554	4,155	3,549	2,319	3,356
Above Normal (16%)	1,607	2,879	3,712	5,445	7,665	6,015	3,579	2,534	2,383	4,775	1,946	2,193
Below Normal (13%)	1,834	2,246	2,291	2,288	4,800	2,188	2,451	1,946	2,168	4,416	1,508	1,222
Dry (24%)	1,547	1,778	1,608	1,582	2,193	2,366	2,266	1,962	2,375	2,806	1,432	1,230
Critical (15%)	1,303	1,443	1,365	1,114	914	1,042	1,251	1,369	1,832	1,545	1,280	1,064
Alternative 3												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,022	3,873	9,622	12,160	14,655	9,756	6,737	7,450	4,944	5,000	3,092	1,949
20%	1,714	3,207	4,325	7,873	10,797	6,816	5,085	4,486	4,005	5,000	2,542	1,687
30%	1,500	2,069	2,733	5,563	7,391	5,044	4,484	3,543	3,661	4,999	2,018	1,533
40%	1,500	1,925	2,000	3,579	5,756	4,172	3,491	2,838	3,200	3,840	1,875	1,533
50%	1,500	1,893	2,000	1,890	3,718	3,047	2,548	2,240	2,664	3,535	1,750	1,533
60%	1,500	1,683	1,960	1,700	2,605	2,017	2,152	1,750	2,230	2,900	1,750	1,533
70%	1,425	1,448	1,596	1,700	1,445	1,747	1,747	1,616	1,851	2,579	1,648	1,493
80%	1,150	1,150	1,244	1,374	1,264	1,059	1,073	1,112	1,598	2,013	1,081	800
90%	800	800	800	825	982	800	800	804	1,011	1,250	800	800
Long Term												
Full Simulation Period ^b	1,496	2,397	3,855	5,095	6,027	4,288	3,390	3,100	2,999	3,396	1,849	1,449
Water Year Types^c												
Wet (32%)	1,696	3,301	7,254	10,565	10,615	7,210	5,522	5,541	4,361	3,511	2,516	1,815
Above Normal (16%)	1,323	2,651	3,693	5,447	7,960	6,141	3,574	2,529	2,982	4,854	1,863	1,539
Below Normal (13%)	1,622	2,285	2,711	2,417	5,174	2,188	2,454	2,009	2,380	4,514	1,728	1,354
Dry (24%)	1,374	1,704	1,661	1,593	2,327	2,389	2,262	1,942	2,453	2,792	1,476	1,229
Critical (15%)	1,336	1,419	1,371	1,153	938	1,041	1,313	1,362	1,542	1,546	1,125	1,012
Alternative 3 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-578	91	1,244	0	0	0	0	0	191	0	8	-2,008
20%	-248	-136	445	217	-93	-4	0	-3	168	0	277	-1,495
30%	-139	-496	657	261	274	-1	-10	0	154	83	52	-893
40%	0	-56	0	-4	-3	-4	0	-24	479	-15	108	-399
50%	0	-32	0	140	631	-10	4	-28	371	-32	0	-32
60%	0	0	115	0	809	-5	41	0	279	46	0	0
70%	-75	-67	2	0	0	0	0	7	101	69	18	13
80%	-32	-75	-125	12	0	206	52	-7	198	-338	186	-8
90%	0	0	0	-160	81	0	0	4	106	113	0	0
Long Term												
Full Simulation Period ^b	-126	-86	207	50	166	25	7	-2	165	10	67	-583
Water Year Types^c												
Wet (32%)	-47	-106	442	76	103	-3	-3	-13	207	-38	197	-1,541
Above Normal (16%)	-284	-228	-19	2	296	126	-5	-5	600	79	-83	-654
Below Normal (13%)	-213	39	420	128	374	0	3	63	212	98	221	133
Dry (24%)	-174	-73	53	11	134	23	-4	-21	77	-14	44	-1
Critical (15%)	33	-24	6	39	24	-1	62	-7	-290	1	-155	-52

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
^b Based on the 82-year simulation period.
^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-27-3. American River d/s of Nimbus Dam, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,600	3,783	8,379	12,160	14,655	9,756	6,737	7,450	4,753	5,000	3,083	3,957
20%	1,962	3,343	3,880	7,656	10,890	6,820	5,085	4,489	3,837	5,000	2,265	3,182
30%	1,639	2,565	2,076	5,303	7,117	5,044	4,494	3,543	3,507	4,916	1,967	2,426
40%	1,500	1,981	2,000	3,583	5,759	4,176	3,491	2,861	2,722	3,856	1,768	1,932
50%	1,500	1,925	2,000	1,750	3,087	3,057	2,544	2,268	2,293	3,567	1,750	1,565
60%	1,500	1,683	1,845	1,700	1,796	2,022	2,111	1,750	1,951	2,854	1,750	1,533
70%	1,500	1,515	1,595	1,700	1,445	1,747	1,747	1,609	1,750	2,510	1,630	1,480
80%	1,182	1,226	1,368	1,362	1,264	854	1,021	1,119	1,401	2,350	895	808
90%	800	800	800	985	901	800	800	800	904	1,137	800	800
Long Term												
Full Simulation Period ^b	1,622	2,483	3,648	5,045	5,861	4,263	3,384	3,103	2,833	3,385	1,783	2,031
Water Year Types^c												
Wet (32%)	1,743	3,407	6,812	10,489	10,512	7,212	5,524	5,554	4,155	3,549	2,319	3,356
Above Normal (16%)	1,607	2,879	3,712	5,445	7,665	6,015	3,579	2,534	2,383	4,775	1,946	2,193
Below Normal (13%)	1,834	2,246	2,291	2,288	4,800	2,188	2,451	1,946	2,168	4,416	1,508	1,222
Dry (24%)	1,547	1,778	1,608	1,582	2,193	2,366	2,266	1,962	2,375	2,806	1,432	1,230
Critical (15%)	1,303	1,443	1,365	1,114	914	1,042	1,251	1,369	1,832	1,545	1,280	1,064

Alternative 5												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,591	3,790	8,385	12,160	14,655	9,756	6,737	7,450	4,997	5,000	2,981	3,872
20%	1,858	3,384	3,894	7,653	10,889	6,820	5,085	4,492	3,883	5,000	2,354	3,145
30%	1,544	2,539	2,092	5,303	7,315	5,044	4,490	3,543	3,613	4,903	1,895	2,423
40%	1,500	1,961	2,000	3,582	5,758	4,175	3,491	2,733	2,886	4,084	1,750	1,910
50%	1,500	1,925	2,000	1,750	3,095	3,057	2,524	2,009	2,330	3,616	1,750	1,533
60%	1,500	1,683	1,823	1,700	1,796	2,022	2,038	1,750	1,965	2,944	1,750	1,533
70%	1,437	1,498	1,608	1,700	1,445	1,747	1,634	1,609	1,750	2,671	1,631	1,356
80%	1,188	1,219	1,262	1,356	1,264	845	1,024	992	1,508	2,392	965	800
90%	800	800	800	992	906	800	800	800	1,006	1,133	800	800
Long Term												
Full Simulation Period ^b	1,596	2,484	3,644	5,034	5,866	4,263	3,364	3,060	2,878	3,473	1,789	1,998
Water Year Types^c												
Wet (32%)	1,728	3,416	6,805	10,493	10,513	7,212	5,524	5,544	4,165	3,654	2,242	3,306
Above Normal (16%)	1,588	2,861	3,698	5,425	7,666	6,024	3,580	2,535	2,374	4,775	1,927	2,204
Below Normal (13%)	1,768	2,251	2,282	2,218	4,766	2,184	2,450	1,916	2,151	4,524	1,499	1,222
Dry (24%)	1,550	1,768	1,619	1,587	2,233	2,363	2,267	1,867	2,384	2,983	1,485	1,239
Critical (15%)	1,239	1,462	1,358	1,111	912	1,041	1,117	1,285	2,121	1,523	1,430	919

Alternative 5 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-9	7	6	0	0	0	0	0	245	0	-102	-85
20%	-104	41	13	-3	-1	0	1	2	46	0	89	-37
30%	-96	-26	16	0	198	0	-4	0	106	-12	-71	-3
40%	0	-20	0	0	0	0	0	-128	164	228	-18	-23
50%	0	0	0	0	7	0	-20	-260	36	49	0	-32
60%	0	0	-22	0	0	0	-73	0	14	90	0	0
70%	-63	-17	13	0	0	0	-112	0	0	161	1	-124
80%	6	-7	-106	-6	0	-8	3	-127	107	41	70	-8
90%	0	0	0	7	6	0	0	0	101	-4	0	0
Long Term												
Full Simulation Period ^b	-26	1	-4	-11	5	0	-19	-43	44	88	6	-33
Water Year Types^c												
Wet (32%)	-16	8	-7	4	0	0	0	-11	10	105	-77	-50
Above Normal (16%)	-19	-18	-14	-20	1	9	1	1	10	-1	-19	11
Below Normal (13%)	-66	5	-9	-70	-34	-4	0	-29	-17	108	-9	0
Dry (24%)	3	-10	11	5	39	-3	1	-96	9	176	53	9
Critical (15%)	-64	19	-7	-4	-2	-1	-134	-85	289	-22	150	-145

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
^b Based on the 82-year simulation period.
^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-27-4. American River d/s of Nimbus Dam, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,967	3,834	9,336	12,160	14,655	9,754	6,737	7,450	4,650	5,000	3,236	1,837
20%	1,500	3,218	4,325	7,873	10,806	6,805	5,083	4,486	3,799	5,000	2,678	1,604
30%	1,500	2,070	2,528	5,813	7,391	5,044	4,483	3,543	3,623	4,957	2,299	1,533
40%	1,500	1,925	2,000	3,587	5,755	4,172	3,491	2,836	3,223	4,250	1,912	1,533
50%	1,500	1,818	2,000	1,776	3,753	3,039	2,499	2,021	2,835	3,591	1,750	1,533
60%	1,500	1,683	1,936	1,700	2,602	2,015	2,089	1,750	2,245	2,935	1,750	1,533
70%	1,449	1,500	1,701	1,700	1,445	1,747	1,750	1,625	1,832	2,589	1,681	1,493
80%	991	1,136	1,146	1,440	1,264	921	1,162	1,074	1,727	2,373	957	800
90%	800	800	800	819	1,032	800	800	800	1,061	1,327	800	780
Long Term												
Full Simulation Period ^b	1,461	2,386	3,826	5,109	6,030	4,279	3,395	3,077	2,987	3,454	1,899	1,404
Water Year Types^c												
Wet (32%)	1,664	3,300	7,242	10,514	10,615	7,209	5,521	5,541	4,226	3,591	2,597	1,756
Above Normal (16%)	1,274	2,549	3,614	5,670	7,969	6,116	3,572	2,527	2,860	4,782	1,913	1,553
Below Normal (13%)	1,661	2,262	2,660	2,370	5,181	2,187	2,477	1,907	2,881	4,610	1,666	1,236
Dry (24%)	1,329	1,698	1,619	1,587	2,322	2,377	2,222	1,925	2,413	3,028	1,446	1,222
Critical (15%)	1,263	1,492	1,400	1,171	951	1,027	1,391	1,327	1,496	1,368	1,336	935

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,600	3,783	8,379	12,160	14,655	9,756	6,737	7,450	4,753	5,000	3,083	3,957
20%	1,962	3,343	3,880	7,656	10,890	6,820	5,085	4,489	3,837	5,000	2,265	3,182
30%	1,639	2,565	2,076	5,303	7,117	5,044	4,494	3,543	3,507	4,916	1,967	2,426
40%	1,500	1,981	2,000	3,583	5,759	4,176	3,491	2,861	2,722	3,856	1,768	1,932
50%	1,500	1,925	2,000	1,750	3,087	3,057	2,544	2,268	2,293	3,567	1,750	1,565
60%	1,500	1,683	1,845	1,700	1,796	2,022	2,111	1,750	1,951	2,854	1,750	1,533
70%	1,500	1,515	1,595	1,700	1,445	1,747	1,747	1,609	1,750	2,510	1,630	1,480
80%	1,182	1,226	1,368	1,362	1,264	854	1,021	1,119	1,401	2,350	895	808
90%	800	800	800	985	901	800	800	800	904	1,137	800	800
Long Term												
Full Simulation Period ^b	1,622	2,483	3,648	5,045	5,861	4,263	3,384	3,103	2,833	3,385	1,783	2,031
Water Year Types^c												
Wet (32%)	1,743	3,407	6,812	10,489	10,512	7,212	5,524	5,554	4,155	3,549	2,319	3,356
Above Normal (16%)	1,607	2,879	3,712	5,445	7,665	6,015	3,579	2,534	2,383	4,775	1,946	2,193
Below Normal (13%)	1,834	2,246	2,291	2,288	4,800	2,188	2,451	1,946	2,168	4,416	1,508	1,222
Dry (24%)	1,547	1,778	1,608	1,582	2,193	2,366	2,266	1,962	2,375	2,806	1,432	1,230
Critical (15%)	1,303	1,443	1,365	1,114	914	1,042	1,251	1,369	1,832	1,545	1,280	1,064

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	633	-52	-957	0	0	2	0	0	103	0	-152	2,120
20%	462	125	-444	-217	84	15	1	3	38	0	-413	1,579
30%	139	495	-452	-510	-274	1	11	0	-116	-41	-333	893
40%	0	56	0	-4	3	4	0	26	-501	-394	-145	399
50%	0	107	0	-26	-665	18	45	247	-541	-24	0	32
60%	0	0	-91	0	-806	7	22	0	-294	-82	0	0
70%	51	15	-107	0	0	0	-3	-16	-82	-79	-51	-13
80%	191	90	222	-78	0	-67	-141	45	-326	-23	-62	8
90%	0	0	0	166	-132	0	0	0	-156	-190	0	20
Long Term												
Full Simulation Period ^b	160	96	-178	-64	-169	-15	-11	26	-154	-69	-116	628
Water Year Types^c												
Wet (32%)	79	107	-430	-25	-102	3	3	13	-72	-42	-278	1,600
Above Normal (16%)	332	330	98	-225	-304	-101	8	7	-477	-6	33	640
Below Normal (13%)	173	-17	-369	-82	-381	1	-27	39	-713	-194	-159	-14
Dry (24%)	219	80	-11	-5	-128	-12	43	38	-37	-222	-14	8
Critical (15%)	40	-49	-35	-56	-38	15	-140	42	336	177	-56	129

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-27-5. American River d/s of Nimbus Dam, Monthly Flow

Second Basis of Comparison												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,967	3,834	9,336	12,160	14,655	9,754	6,737	7,450	4,650	5,000	3,236	1,837
20%	1,500	3,218	4,325	7,873	10,806	6,805	5,083	4,486	3,799	5,000	2,678	1,604
30%	1,500	2,070	2,528	5,813	7,391	5,044	4,483	3,543	3,623	4,957	2,299	1,533
40%	1,500	1,925	2,000	3,587	5,755	4,172	3,491	2,836	3,223	4,250	1,912	1,533
50%	1,500	1,818	2,000	1,776	3,753	3,039	2,499	2,021	2,835	3,591	1,750	1,533
60%	1,500	1,683	1,936	1,700	2,602	2,015	2,089	1,750	2,245	2,935	1,750	1,533
70%	1,449	1,500	1,701	1,700	1,445	1,747	1,750	1,625	1,832	2,589	1,681	1,493
80%	991	1,136	1,146	1,440	1,264	921	1,162	1,074	1,727	2,373	957	800
90%	800	800	800	819	1,032	800	800	800	1,061	1,327	800	780
Long Term												
Full Simulation Period ^b	1,461	2,386	3,826	5,109	6,030	4,279	3,395	3,077	2,987	3,454	1,899	1,404
Water Year Types^c												
Wet (32%)	1,664	3,300	7,242	10,514	10,615	7,209	5,521	5,541	4,226	3,591	2,597	1,756
Above Normal (16%)	1,274	2,549	3,614	5,670	7,969	6,116	3,572	2,527	2,860	4,782	1,913	1,553
Below Normal (13%)	1,661	2,262	2,660	2,370	5,181	2,187	2,477	1,907	2,881	4,610	1,666	1,236
Dry (24%)	1,329	1,698	1,619	1,587	2,322	2,377	2,222	1,925	2,413	3,028	1,446	1,222
Critical (15%)	1,263	1,492	1,400	1,171	951	1,027	1,391	1,327	1,496	1,368	1,336	935

Alternative 3

Alternative 3												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,022	3,873	9,622	12,160	14,655	9,756	6,737	7,450	4,944	5,000	3,092	1,949
20%	1,714	3,207	4,325	7,873	10,797	6,816	5,085	4,486	4,005	5,000	2,542	1,687
30%	1,500	2,069	2,733	5,563	7,391	5,044	4,484	3,543	3,661	4,999	2,018	1,533
40%	1,500	1,925	2,000	3,579	5,756	4,172	3,491	2,838	3,200	3,840	1,875	1,533
50%	1,500	1,893	2,000	1,890	3,718	3,047	2,548	2,240	2,664	3,535	1,750	1,533
60%	1,500	1,683	1,960	1,700	2,605	2,017	2,152	1,750	2,230	2,900	1,750	1,533
70%	1,425	1,448	1,596	1,700	1,445	1,747	1,747	1,616	1,851	2,579	1,648	1,493
80%	1,150	1,150	1,244	1,374	1,264	1,059	1,073	1,112	1,598	2,013	1,081	800
90%	800	800	800	825	982	800	800	804	1,011	1,250	800	800
Long Term												
Full Simulation Period ^b	1,496	2,397	3,855	5,095	6,027	4,288	3,390	3,100	2,999	3,396	1,849	1,449
Water Year Types^c												
Wet (32%)	1,696	3,301	7,254	10,565	10,615	7,210	5,522	5,541	4,361	3,511	2,516	1,815
Above Normal (16%)	1,323	2,651	3,693	5,447	7,960	6,141	3,574	2,529	2,982	4,854	1,863	1,539
Below Normal (13%)	1,622	2,285	2,711	2,417	5,174	2,188	2,454	2,009	2,380	4,514	1,728	1,354
Dry (24%)	1,374	1,704	1,661	1,593	2,327	2,389	2,262	1,942	2,453	2,792	1,476	1,229
Critical (15%)	1,336	1,419	1,371	1,153	938	1,041	1,313	1,362	1,542	1,546	1,125	1,012

Alternative 3 minus Second Basis of Comparison

Alternative 3 minus Second Basis of Comparison												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	55	39	286	0	0	2	0	0	294	0	-144	112
20%	214	-11	1	0	-9	11	1	0	206	0	-137	84
30%	0	-1	205	-250	0	0	1	0	38	42	-281	0
40%	0	0	0	-8	0	0	0	2	-22	-410	-37	0
50%	0	75	0	113	-34	7	49	219	-171	-56	0	0
60%	0	0	24	0	3	2	63	0	-14	-35	0	0
70%	-24	-52	-105	0	0	0	-3	-9	18	-10	-33	0
80%	159	15	98	-66	0	138	-89	38	-129	-360	124	0
90%	0	0	0	6	-51	0	0	4	-50	-77	0	20
Long Term												
Full Simulation Period ^b	34	10	29	-14	-3	9	-4	23	11	-58	-49	45
Water Year Types^c												
Wet (32%)	32	1	12	51	1	0	1	0	135	-80	-82	59
Above Normal (16%)	49	103	79	-223	-8	25	2	2	123	72	-50	-14
Below Normal (13%)	-39	22	51	46	-7	1	-23	102	-501	-96	62	119
Dry (24%)	45	6	42	6	6	12	39	17	40	-236	29	7
Critical (15%)	73	-73	-29	-18	-14	14	-77	34	46	178	-211	76

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-27-6. American River d/s of Nimbus Dam, Monthly Flow

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance^a												
10%	1,967	3,834	9,336	12,160	14,655	9,754	6,737	7,450	4,650	5,000	3,236	1,837
20%	1,500	3,218	4,325	7,873	10,806	6,805	5,083	4,486	3,799	5,000	2,678	1,604
30%	1,500	2,070	2,528	5,813	7,391	5,044	4,483	3,543	3,623	4,957	2,299	1,533
40%	1,500	1,925	2,000	3,587	5,755	4,172	3,491	2,836	3,223	4,250	1,912	1,533
50%	1,500	1,818	2,000	1,776	3,753	3,039	2,499	2,021	2,835	3,591	1,750	1,533
60%	1,500	1,683	1,936	1,700	2,602	2,015	2,089	1,750	2,245	2,935	1,750	1,533
70%	1,449	1,500	1,701	1,700	1,445	1,747	1,750	1,625	1,832	2,589	1,681	1,493
80%	991	1,136	1,146	1,440	1,264	921	1,162	1,074	1,727	2,373	957	800
90%	800	800	800	819	1,032	800	800	800	800	1,061	1,327	800
Long Term												
Full Simulation Period ^b	1,461	2,386	3,826	5,109	6,030	4,279	3,395	3,077	2,987	3,454	1,899	1,404
Water Year Types^c												
Wet (32%)	1,664	3,300	7,242	10,514	10,615	7,209	5,521	5,541	4,226	3,591	2,597	1,756
Above Normal (16%)	1,274	2,549	3,614	5,670	7,969	6,116	3,572	2,527	2,860	4,782	1,913	1,553
Below Normal (13%)	1,661	2,262	2,660	2,370	5,181	2,187	2,477	1,907	2,881	4,610	1,666	1,236
Dry (24%)	1,329	1,698	1,619	1,587	2,322	2,377	2,222	1,925	2,413	3,028	1,446	1,222
Critical (15%)	1,263	1,492	1,400	1,171	951	1,027	1,391	1,327	1,496	1,368	1,336	935

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,591	3,790	8,385	12,160	14,655	9,756	6,737	7,450	4,997	5,000	2,981	3,872
20%	1,858	3,384	3,894	7,653	10,889	6,820	5,085	4,492	3,883	5,000	2,354	3,145
30%	1,544	2,539	2,092	5,303	7,315	5,044	4,490	3,543	3,613	4,903	1,895	2,423
40%	1,500	1,961	2,000	3,582	5,758	4,175	3,491	2,733	2,886	4,084	1,750	1,910
50%	1,500	1,925	2,000	1,750	3,095	3,057	2,524	2,009	2,330	3,616	1,750	1,533
60%	1,500	1,683	1,823	1,700	1,796	2,022	2,038	1,750	1,965	2,944	1,750	1,533
70%	1,437	1,498	1,608	1,700	1,445	1,747	1,634	1,609	1,750	2,671	1,631	1,356
80%	1,188	1,219	1,262	1,356	1,264	845	1,024	992	1,508	2,392	965	800
90%	800	800	800	992	906	800	800	800	1,006	1,133	800	800
Long Term												
Full Simulation Period ^b	1,596	2,484	3,644	5,034	5,866	4,263	3,364	3,060	2,878	3,473	1,789	1,998
Water Year Types^c												
Wet (32%)	1,728	3,416	6,805	10,493	10,513	7,212	5,524	5,544	4,165	3,654	2,242	3,306
Above Normal (16%)	1,588	2,861	3,698	5,425	7,666	6,024	3,580	2,535	2,374	4,775	1,927	2,204
Below Normal (13%)	1,768	2,251	2,282	2,218	4,766	2,184	2,450	1,916	2,151	4,524	1,499	1,222
Dry (24%)	1,550	1,768	1,619	1,587	2,233	2,363	2,267	1,867	2,384	2,983	1,485	1,239
Critical (15%)	1,239	1,462	1,358	1,111	912	1,041	1,117	1,285	2,121	1,523	1,430	919

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	624	-44	-951	0	0	2	0	0	347	0	-255	2,035
20%	358	166	-431	-220	83	15	2	6	84	0	-324	1,541
30%	44	469	-435	-510	-76	0	7	0	-10	-54	-404	890
40%	0	36	0	-5	3	3	0	-102	-336	-166	-162	376
50%	0	107	0	-26	-658	18	25	-12	-505	25	0	0
60%	0	0	-113	0	-806	7	-51	0	-279	8	0	0
70%	-12	-2	-93	0	0	0	-116	-16	-82	82	-50	-137
80%	197	83	116	-84	0	-76	-138	-82	-219	19	8	0
90%	0	0	0	173	-126	0	0	0	-55	-194	0	20
Long Term												
Full Simulation Period ^b	135	97	-182	-75	-164	-15	-30	-17	-110	19	-110	595
Water Year Types^c												
Wet (32%)	63	115	-437	-21	-102	3	3	2	-61	63	-355	1,550
Above Normal (16%)	314	312	84	-245	-303	-92	9	8	-486	-7	13	651
Below Normal (13%)	107	-12	-378	-152	-416	-3	-27	10	-730	-86	-167	-14
Dry (24%)	221	70	-1	0	-89	-14	44	-58	-28	-45	39	17
Critical (15%)	-24	-29	-42	-60	-40	14	-273	-43	625	155	93	-16

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1 **C.28. Sacramento River Flow at Freeport**


Figure C-28-1. Sacramento River at Freeport, Long-Term* Average Flow

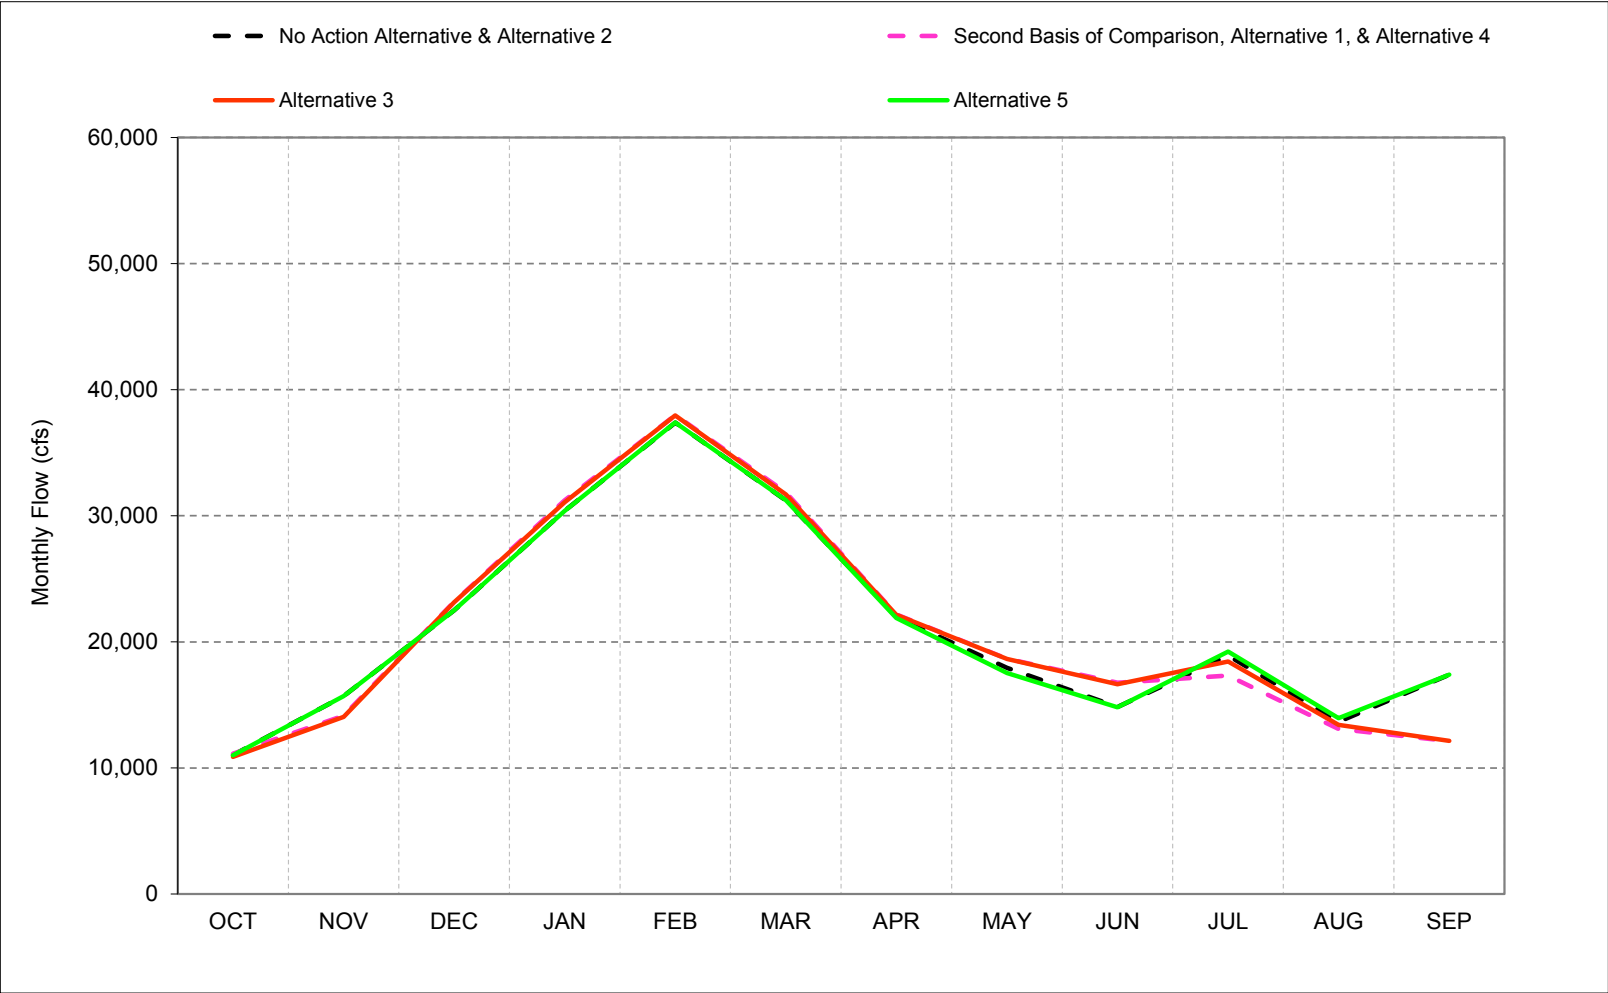

*Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-28-2. Sacramento River at Freeport, Wet Year* Long-Term** Average Flow

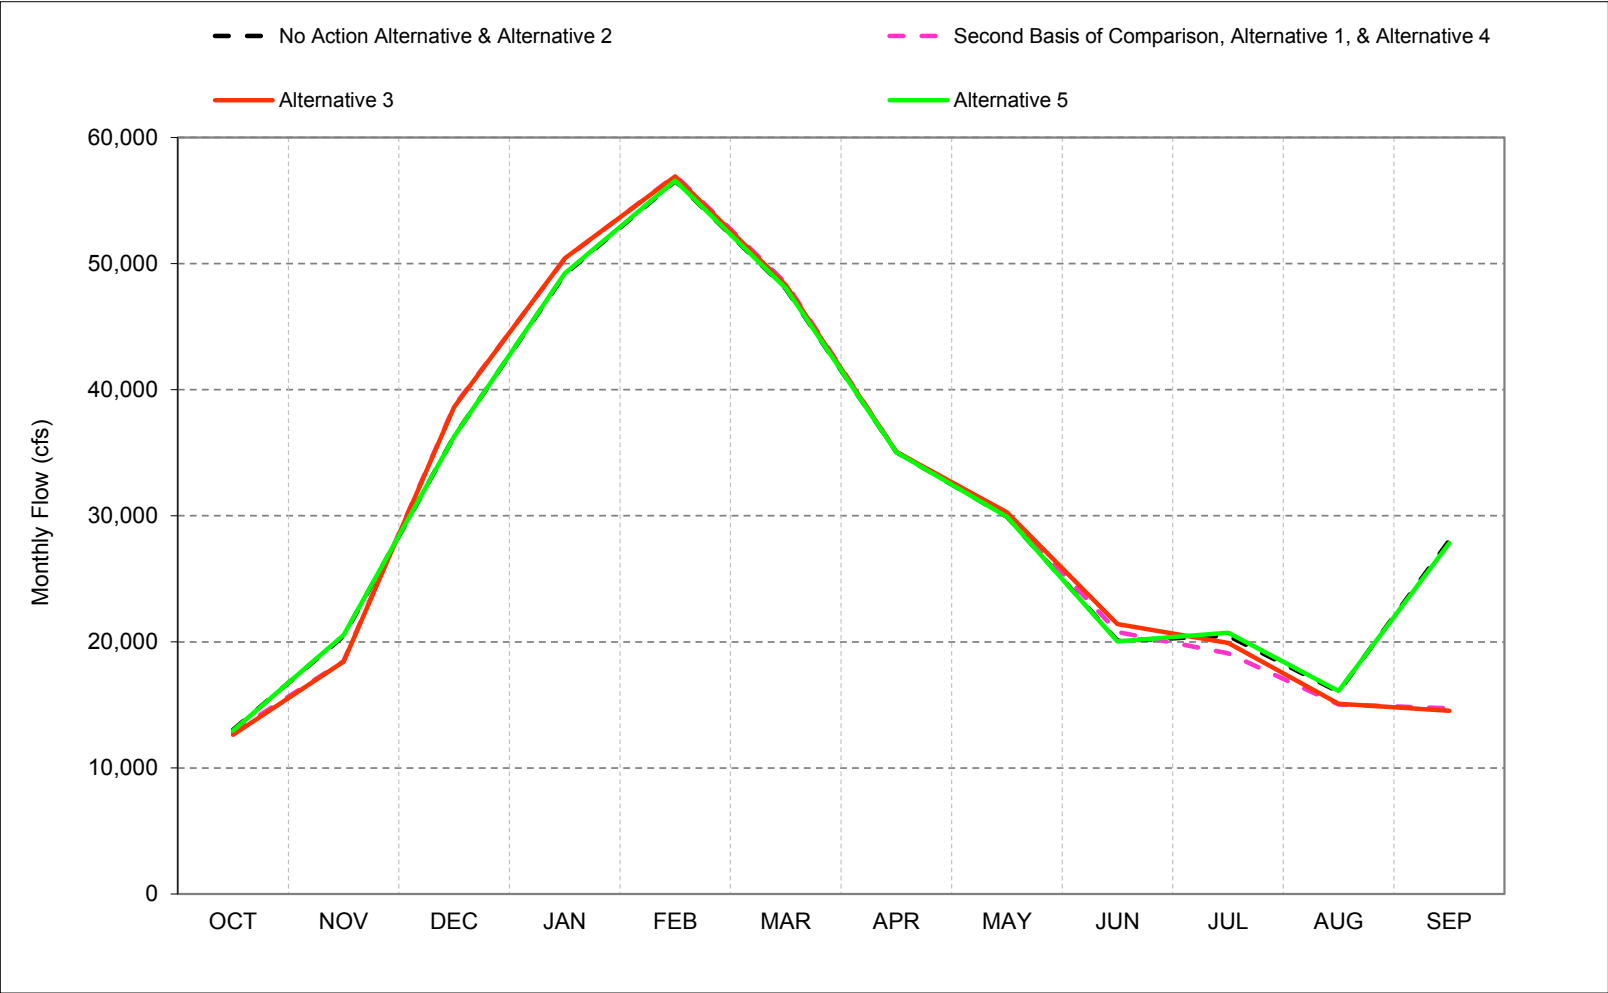


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-28-3. Sacramento River at Freeport, Above Normal Year* Long-Term** Average Flow

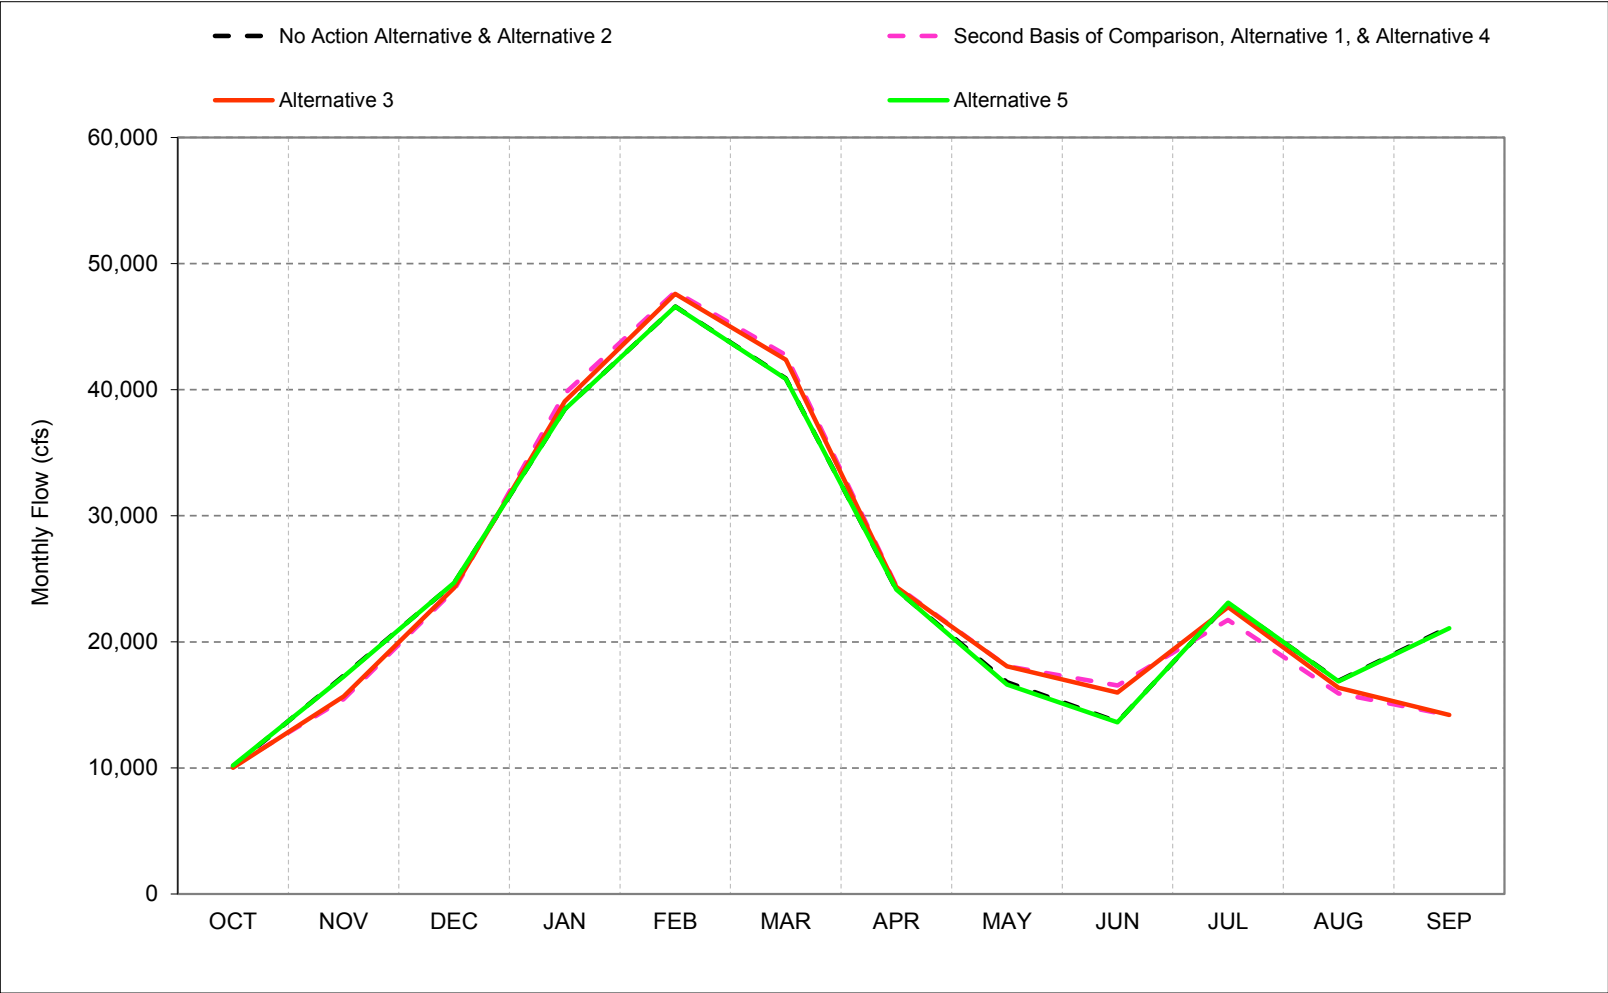


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-28-4. Sacramento River at Freeport, Below Normal Year* Long-Term** Average Flow

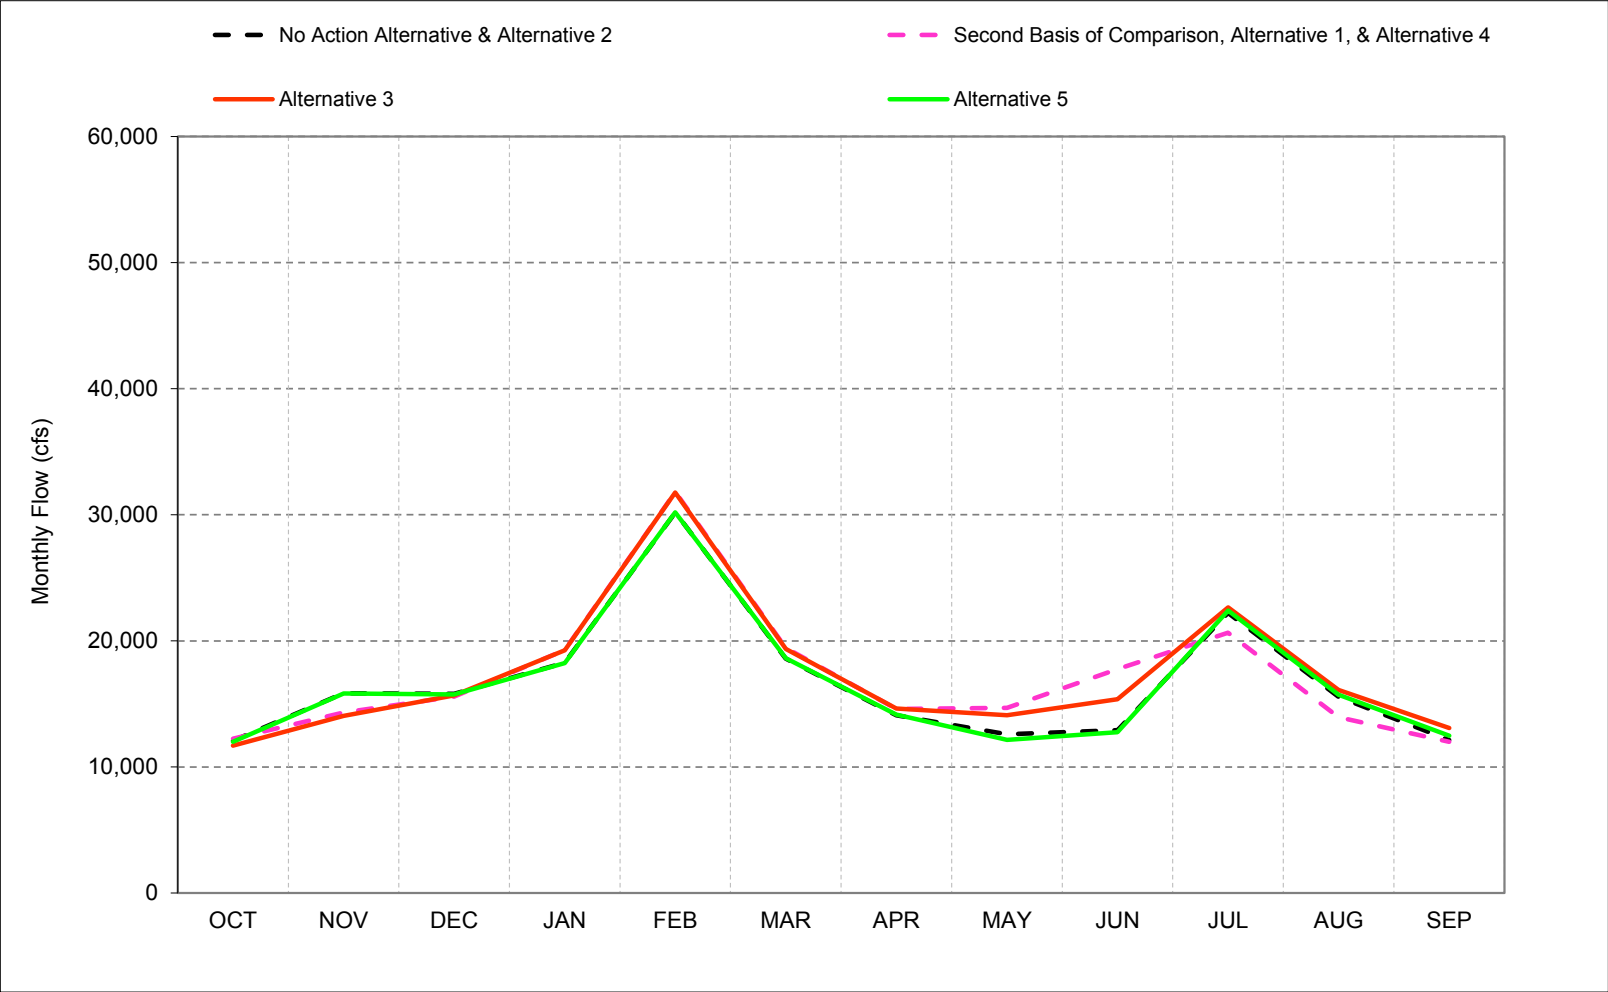


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-28-5. Sacramento River at Freeport, Dry Year* Long-Term** Average Flow

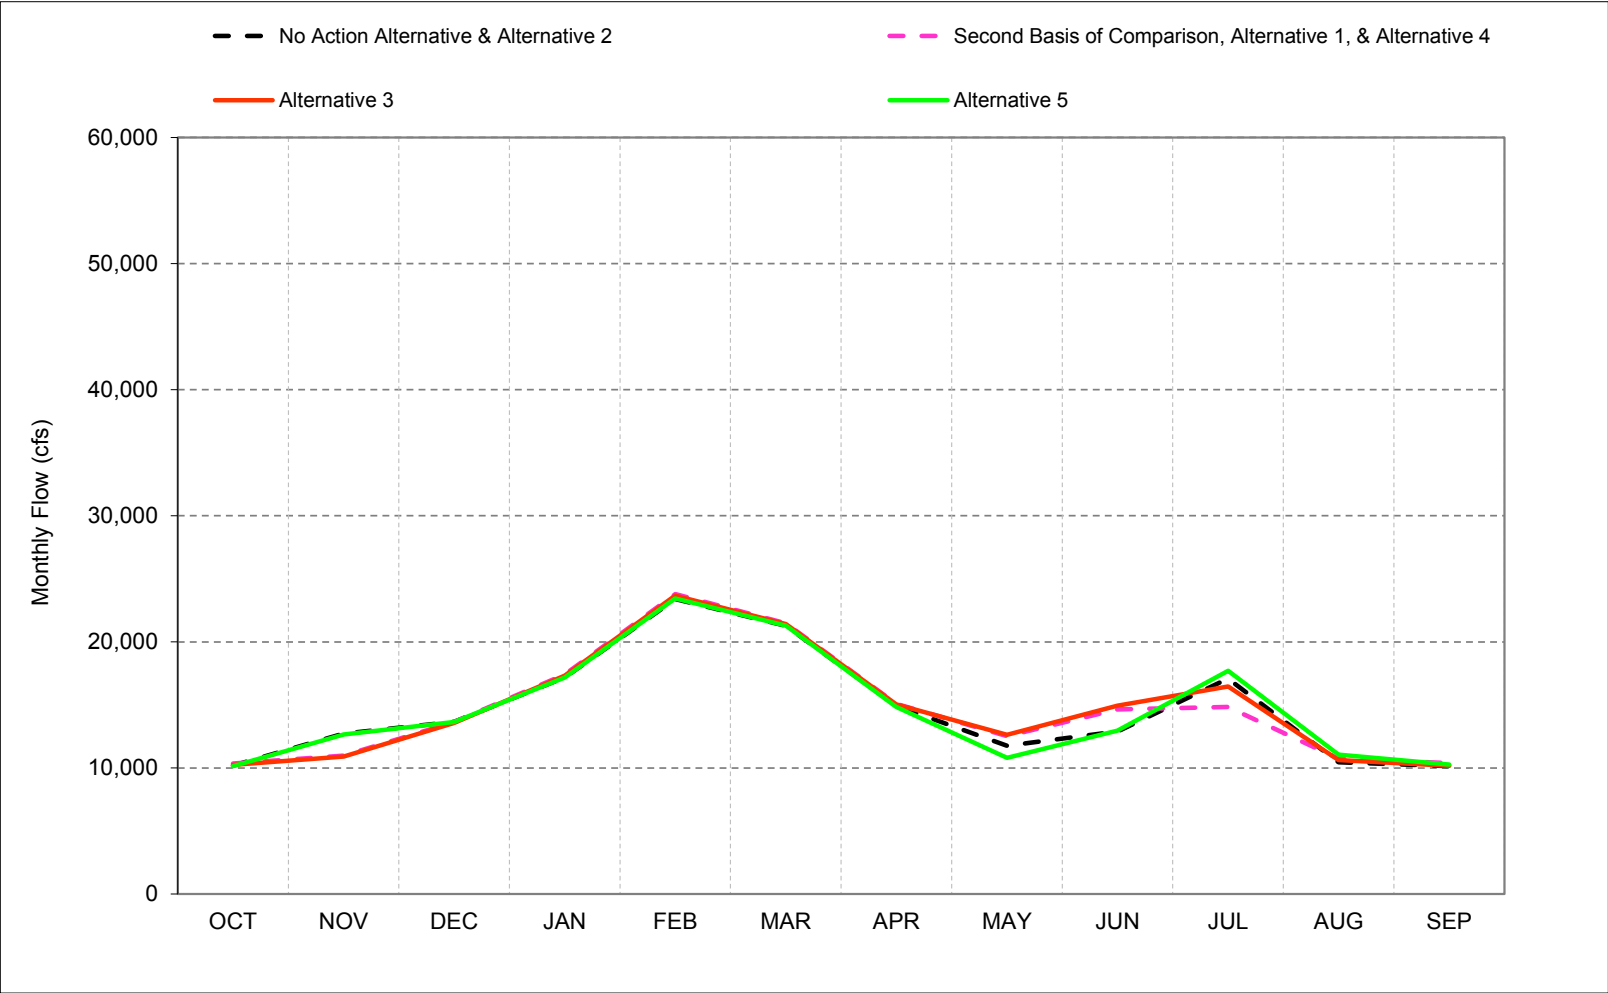


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-28-6. Sacramento River at Freeport, Critical Year* Long-Term** Average Flow

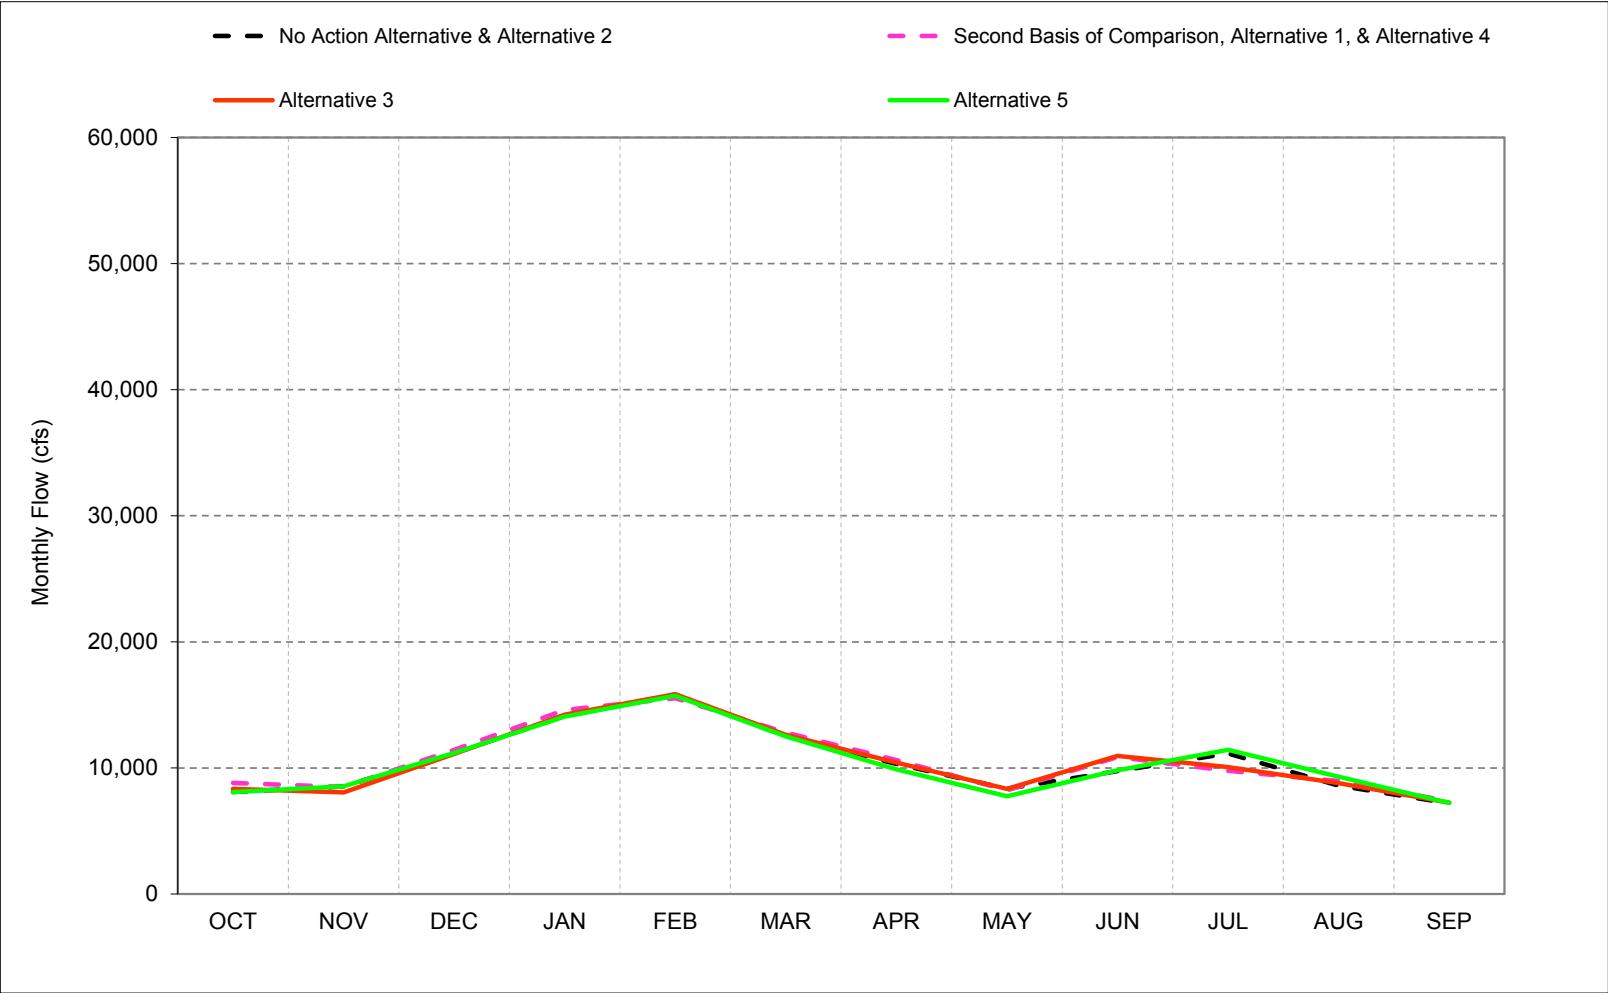

*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-28-1. Sacramento River at Freepoint, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	14,943	22,413	49,061	63,978	70,378	62,016	46,176	38,567	19,878	24,622	17,168	29,174
20%	14,024	18,968	32,387	52,720	61,625	51,028	32,558	25,925	16,015	24,044	16,812	28,630
30%	13,242	18,223	21,284	38,363	49,339	37,119	22,938	16,497	13,891	22,798	16,216	22,285
40%	12,114	16,756	17,972	24,564	42,829	29,446	19,999	13,452	13,365	20,928	15,920	21,314
50%	10,960	15,237	15,541	20,767	32,462	24,475	15,899	12,324	13,076	19,016	14,837	14,553
60%	9,175	13,091	15,097	18,151	24,481	20,699	12,818	11,385	12,593	17,772	13,961	12,554
70%	8,278	10,048	13,503	14,788	19,200	18,284	11,560	11,000	12,084	16,743	11,450	10,186
80%	7,916	8,600	10,754	13,471	16,242	14,866	10,757	10,413	11,011	15,241	9,408	8,418
90%	6,406	7,499	9,330	11,750	13,930	11,376	9,707	8,994	10,151	11,748	8,218	6,959
Long Term												
Full Simulation Period ^b	11,027	15,700	22,511	30,389	37,384	31,227	21,984	17,938	14,845	18,927	13,660	17,395
Water Year Types ^c												
Wet (32%)	13,028	20,442	36,300	49,140	56,543	48,019	35,045	29,928	20,087	20,487	16,031	28,019
Above Normal (16%)	10,118	17,302	24,668	38,462	46,588	40,888	24,137	16,812	13,665	23,051	16,920	21,159
Below Normal (13%)	12,085	15,834	15,808	18,273	30,185	18,600	14,108	12,602	12,927	22,211	15,563	12,132
Dry (24%)	10,191	12,717	13,654	17,185	23,392	21,285	14,927	11,770	12,904	17,081	10,453	10,150
Critical (15%)	8,102	8,539	11,205	14,132	15,821	12,526	10,333	8,354	9,755	11,143	8,590	7,198
Alternative 1												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	14,535	22,483	54,532	64,835	70,451	63,654	46,241	38,579	21,089	23,075	16,647	15,053
20%	14,097	14,990	34,381	56,263	62,040	51,425	32,543	27,633	18,924	21,676	15,939	14,645
30%	13,025	13,727	22,366	41,579	51,549	41,505	22,929	17,142	17,961	20,420	15,394	14,129
40%	11,580	13,241	18,580	26,629	45,721	29,974	20,054	15,174	16,521	19,429	14,779	13,931
50%	10,818	12,087	15,606	23,009	33,290	24,771	16,394	13,624	15,588	18,340	13,795	13,397
60%	10,029	11,225	14,369	18,466	24,734	20,966	12,916	12,737	14,567	16,653	12,006	11,957
70%	9,019	10,194	12,581	15,005	19,838	18,448	11,708	11,915	13,085	14,599	10,893	9,897
80%	8,009	8,857	10,799	13,486	16,580	15,217	11,229	10,874	12,353	12,878	9,767	8,646
90%	6,709	7,537	9,360	11,871	14,217	11,487	10,200	8,922	11,289	10,339	8,546	7,115
Long Term												
Full Simulation Period ^b	11,135	14,147	23,180	31,236	37,980	31,862	22,179	18,663	16,752	17,326	13,094	12,141
Water Year Types ^c												
Wet (32%)	12,828	18,463	38,689	50,375	56,977	48,450	35,060	30,181	20,772	19,106	15,038	14,726
Above Normal (16%)	10,150	15,450	24,122	39,692	47,763	42,758	24,410	18,064	16,533	21,746	15,907	14,192
Below Normal (13%)	12,254	14,318	15,586	19,280	31,808	19,442	14,599	14,690	17,758	20,643	13,951	12,000
Dry (24%)	10,354	10,984	13,633	17,418	23,789	21,475	15,084	12,519	14,646	14,838	10,740	10,387
Critical (15%)	8,809	8,499	11,430	14,601	15,535	12,818	10,626	8,240	10,863	9,787	8,969	7,370
Alternative 1 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-408	69	5,471	857	73	1,638	65	12	1,211	-1,546	-521	-14,121
20%	73	-3,978	1,994	3,543	414	397	-16	1,708	2,910	-2,368	-873	-13,985
30%	-218	-4,496	1,083	3,216	2,211	4,386	-9	645	4,070	-2,378	-821	-8,157
40%	-534	-3,515	608	2,066	2,892	528	55	1,722	3,156	-1,498	-1,142	-7,383
50%	-142	-3,150	65	2,242	828	296	495	1,300	2,512	-676	-1,042	-1,156
60%	855	-1,866	-728	316	253	267	98	1,352	1,974	-1,119	-1,954	-597
70%	741	146	-923	217	638	164	148	916	1,000	-2,145	-557	-289
80%	94	257	45	15	339	350	472	461	1,343	-2,363	360	228
90%	303	38	30	121	288	111	493	-72	1,138	-1,409	327	157
Long Term												
Full Simulation Period ^b	108	-1,553	669	847	596	635	195	725	1,907	-1,601	-566	-5,254
Water Year Types ^c												
Wet (32%)	-200	-1,979	2,389	1,235	433	431	15	253	685	-1,381	-993	-13,293
Above Normal (16%)	32	-1,852	-547	1,230	1,175	1,870	273	1,252	2,868	-1,304	-1,014	-6,966
Below Normal (13%)	169	-1,516	-223	1,007	1,623	842	491	2,088	4,831	-1,568	-1,611	-1,32
Dry (24%)	163	-1,733	-22	233	396	190	157	750	1,742	-2,243	287	237
Critical (15%)	707	-40	226	469	-286	292	293	-113	1,108	-1,357	379	172

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-28-2. Sacramento River at Freepoint, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	14,943	22,413	49,061	63,978	70,378	62,016	46,176	38,567	19,878	24,622	17,168	29,174
20%	14,024	18,968	32,387	52,720	61,625	51,028	32,558	25,925	16,015	24,044	16,812	28,630
30%	13,242	18,223	21,284	38,363	49,339	37,119	22,938	16,497	13,891	22,798	16,216	22,285
40%	12,114	16,756	17,972	24,564	42,829	29,446	19,999	13,452	13,365	20,928	15,920	21,314
50%	10,960	15,237	15,541	20,767	32,462	24,475	15,899	12,324	13,076	19,016	14,837	14,553
60%	9,175	13,091	15,097	18,151	24,481	20,699	12,818	11,385	12,593	17,772	13,961	12,554
70%	8,278	10,048	13,503	14,788	19,200	18,284	11,560	11,000	12,084	16,743	11,450	10,186
80%	7,916	8,600	10,754	13,471	16,242	14,866	10,757	10,413	11,011	15,241	9,408	8,418
90%	6,406	7,499	9,330	11,750	13,930	11,376	9,707	8,994	10,151	11,748	8,218	6,959
Long Term												
Full Simulation Period ^b	11,027	15,700	22,511	30,389	37,384	31,227	21,984	17,938	14,845	18,927	13,660	17,395
Water Year Types ^c												
Wet (32%)	13,028	20,442	36,300	49,140	56,543	48,019	35,045	29,928	20,087	20,487	16,031	28,019
Above Normal (16%)	10,118	17,302	24,668	38,462	46,588	40,888	24,137	16,812	13,665	23,051	16,920	21,159
Below Normal (13%)	12,085	15,834	15,808	18,273	30,185	18,600	14,108	12,602	12,927	22,211	15,563	12,132
Dry (24%)	10,191	12,717	13,654	17,185	23,392	21,285	14,927	11,770	12,904	17,081	10,453	10,150
Critical (15%)	8,102	8,539	11,205	14,132	15,821	12,526	10,333	8,354	9,755	11,143	8,590	7,198
Alternative 3												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	14,522	22,777	54,349	64,547	70,425	63,650	46,194	38,572	19,618	24,124	16,982	15,306
20%	14,016	15,433	35,012	55,813	62,015	51,429	32,554	26,881	18,690	23,538	16,423	14,750
30%	12,928	13,874	22,439	41,575	51,558	39,917	22,941	17,225	16,622	22,859	15,633	14,073
40%	11,616	12,936	18,500	26,437	45,279	29,972	19,998	15,149	16,079	21,097	15,244	13,635
50%	10,659	12,079	15,589	22,431	33,014	24,758	16,406	13,375	15,441	19,572	14,373	13,300
60%	9,263	11,153	13,999	18,180	24,733	20,947	12,825	12,360	14,633	17,322	13,505	12,363
70%	8,269	10,294	12,891	14,734	20,406	18,647	11,997	11,712	14,169	15,486	11,575	9,959
80%	7,912	8,827	11,039	13,490	16,256	15,202	10,876	11,076	12,499	13,687	9,625	8,924
90%	6,450	7,533	9,307	11,790	14,187	11,426	10,192	9,200	11,354	10,481	8,411	6,941
Long Term												
Full Simulation Period ^b	10,882	14,066	23,134	31,069	37,948	31,691	22,137	18,659	16,634	18,450	13,425	12,156
Water Year Types ^c												
Wet (32%)	12,631	18,451	38,620	50,401	56,918	48,277	35,056	30,274	21,422	19,904	15,099	14,529
Above Normal (16%)	10,011	15,687	24,282	39,084	47,607	42,363	24,359	18,074	15,986	22,756	16,372	14,207
Below Normal (13%)	11,703	14,058	15,668	19,267	31,751	19,354	14,632	14,094	15,368	22,662	16,099	13,094
Dry (24%)	10,247	10,917	13,572	17,315	23,665	21,407	15,052	12,639	14,931	16,466	10,640	10,168
Critical (15%)	8,345	8,067	11,116	14,242	15,868	12,641	10,425	8,341	10,959	10,077	8,799	7,248
Alternative 3 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-421	363	5,288	569	48	1,634	17	5	-261	-498	-186	-13,869
20%	-8	-3,535	2,626	3,092	390	401	-4	956	2,676	-506	-390	-13,880
30%	-314	-4,349	1,155	3,212	2,219	2,797	3	728	2,731	61	-582	-8,213
40%	-498	-3,820	528	1,874	2,450	526	-1	1,698	2,714	170	-677	-7,679
50%	-301	-3,158	48	1,664	552	283	507	1,052	2,364	556	-464	-1,253
60%	88	-1,938	-1,098	30	251	249	7	975	2,040	-450	-456	-191
70%	-9	246	-612	-54	1,205	363	436	712	2,084	-1,258	125	-227
80%	-3	227	285	20	14	336	119	663	1,488	-1,553	218	506
90%	45	33	-22	40	257	50	485	206	1,204	-1,267	193	-18
Long Term												
Full Simulation Period ^b	-145	-1,634	623	680	564	464	153	720	1,789	-477	-234	-5,239
Water Year Types ^c												
Wet (32%)	-397	-1,991	2,320	1,261	375	259	11	346	1,335	-583	-933	-13,490
Above Normal (16%)	-108	-1,615	-386	622	1,019	1,475	222	1,262	2,321	-294	-548	-6,952
Below Normal (13%)	-382	-1,777	-141	994	1,567	754	524	1,493	2,440	452	536	962
Dry (24%)	57	-1,800	-82	130	272	122	126	870	2,027	-615	188	19
Critical (15%)	243	-472	-88	111	47	116	93	-13	1,204	-1,066	209	50

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-28-3. Sacramento River at Freepport, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	14,943	22,413	49,061	63,978	70,378	62,016	46,176	38,567	19,878	24,622	17,168	29,174
20%	14,024	18,968	32,387	52,720	61,625	51,028	32,558	25,925	16,015	24,044	16,812	28,630
30%	13,242	18,223	21,284	38,363	49,339	37,119	22,938	16,497	13,891	22,798	16,216	22,285
40%	12,114	16,756	17,972	24,564	42,829	29,446	19,999	13,452	13,365	20,928	15,920	21,314
50%	10,960	15,237	15,541	20,767	32,462	24,475	15,899	12,324	13,076	19,016	14,837	14,553
60%	9,175	13,091	15,097	18,151	24,481	20,699	12,818	11,385	12,593	17,772	13,961	12,554
70%	8,278	10,048	13,503	14,788	19,200	18,284	11,560	11,000	12,084	16,743	11,450	10,186
80%	7,916	8,600	10,754	13,471	16,242	14,866	10,757	10,413	11,011	15,241	9,408	8,418
90%	6,406	7,499	9,330	11,750	13,930	11,376	9,707	8,994	10,151	11,748	8,218	6,959
Long Term												
Full Simulation Period ^b	11,027	15,700	22,511	30,389	37,384	31,227	21,984	17,938	14,845	18,927	13,660	17,395
Water Year Types^c												
Wet (32%)	13,028	20,442	36,300	49,140	56,543	48,019	35,045	29,928	20,087	20,487	16,031	28,019
Above Normal (16%)	10,118	17,302	24,668	38,462	46,588	40,888	24,137	16,812	13,665	23,051	16,920	21,159
Below Normal (13%)	12,085	15,834	15,808	18,273	30,185	18,600	14,108	12,602	12,927	22,211	15,563	12,132
Dry (24%)	10,191	12,717	13,654	17,185	23,392	21,285	14,927	11,770	12,904	17,081	10,453	10,150
Critical (15%)	8,102	8,539	11,205	14,132	15,821	12,526	10,333	8,354	9,755	11,143	8,590	7,198

Alternative 5												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	14,940	22,403	48,958	63,738	70,363	62,025	46,178	38,574	19,953	24,625	17,185	29,151
20%	13,753	18,981	32,387	52,655	61,599	51,038	32,559	25,815	16,141	24,012	16,842	28,386
30%	13,111	18,329	21,304	38,363	49,567	37,212	22,950	16,490	13,942	23,249	16,214	22,293
40%	11,971	16,727	17,992	24,503	42,844	29,460	20,004	12,900	13,403	21,099	15,960	21,312
50%	10,996	15,185	15,541	20,791	32,715	24,379	15,901	11,905	13,055	19,737	15,468	14,746
60%	9,175	13,119	15,099	18,100	24,483	20,700	12,517	11,096	12,619	18,365	14,543	13,155
70%	8,302	10,026	13,584	14,777	19,202	18,200	11,777	10,131	12,094	17,451	11,864	10,306
80%	7,912	8,595	10,753	13,467	16,241	14,863	10,304	9,401	10,762	15,630	9,789	8,689
90%	6,444	7,512	9,293	11,701	13,900	11,364	9,585	8,003	10,127	11,885	8,975	7,378
Long Term												
Full Simulation Period ^b	11,003	15,715	22,497	30,404	37,388	31,223	21,901	17,523	14,824	19,224	13,951	17,409
Water Year Types^c												
Wet (32%)	12,973	20,552	36,278	49,232	56,574	48,034	35,045	29,921	20,050	20,717	16,120	27,839
Above Normal (16%)	10,196	17,255	24,677	38,449	46,580	40,841	24,141	16,617	13,618	23,104	16,859	21,070
Below Normal (13%)	12,003	15,829	15,766	18,240	30,181	18,617	14,146	12,152	12,755	22,395	15,727	12,486
Dry (24%)	10,157	12,669	13,658	17,178	23,432	21,280	14,835	10,813	12,951	17,695	11,049	10,285
Critical (15%)	8,100	8,542	11,179	14,090	15,730	12,507	9,883	7,752	9,826	11,428	9,309	7,230

Alternative 5 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-3	-10	-103	-240	-15	9	1	7	75	3	17	-24
20%	-271	13	0	-65	-27	10	1	-111	126	-32	29	-244
30%	-131	105	20	0	228	92	12	-7	51	451	-2	7
40%	-143	-29	20	-60	15	14	5	-551	38	171	40	-2
50%	36	-52	0	24	252	-96	2	-418	-21	721	631	193
60%	0	28	2	-50	1	1	-301	-289	26	592	582	602
70%	24	-22	81	-11	2	-84	217	-869	10	708	414	121
80%	-3	-5	-1	-4	-1	-3	-452	-1,012	-249	389	381	271
90%	38	12	-37	-49	-30	-12	-122	-991	-24	137	757	419
Long Term												
Full Simulation Period ^b	-24	15	-14	15	4	-4	-82	-415	-20	298	291	14
Water Year Types^c												
Wet (32%)	-55	110	-22	92	31	15	0	-8	-37	230	88	-180
Above Normal (16%)	78	-47	9	-13	-9	-47	4	-195	-47	54	-61	-89
Below Normal (13%)	-82	-6	-42	-33	-4	17	38	-450	-172	184	165	354
Dry (24%)	-34	-48	4	-7	39	-5	-92	-957	47	614	596	135
Critical (15%)	-1	3	-26	-42	-92	-19	-450	-602	71	285	719	31

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-28-4. Sacramento River at Freepoint, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	14,535	22,483	54,532	64,835	70,451	63,654	46,241	38,579	21,089	23,075	16,647	15,053
20%	14,097	14,990	34,381	56,263	62,040	51,425	32,543	27,633	18,924	21,676	15,939	14,645
30%	13,025	13,727	22,366	41,579	51,549	41,505	22,929	17,142	17,961	20,420	15,394	14,129
40%	11,580	13,241	18,580	26,629	45,721	29,974	20,054	15,174	16,521	19,429	14,779	13,931
50%	10,818	12,087	15,606	23,009	33,290	24,771	16,394	13,624	15,588	18,340	13,795	13,397
60%	10,029	11,225	14,369	18,466	24,734	20,966	12,916	12,737	14,567	16,653	12,006	11,957
70%	9,019	10,194	12,581	15,005	19,838	18,448	11,708	11,915	13,085	14,599	10,893	9,897
80%	8,009	8,857	10,799	13,486	16,580	15,217	11,229	10,874	12,353	12,878	9,767	8,646
90%	6,709	7,537	9,360	11,871	14,217	11,487	10,200	8,922	11,289	10,339	8,546	7,115
Long Term												
Full Simulation Period ^b	11,135	14,147	23,180	31,236	37,980	31,862	22,179	18,663	16,752	17,326	13,094	12,141
Water Year Types^c												
Wet (32%)	12,828	18,463	38,689	50,375	56,977	48,450	35,060	30,181	20,772	19,106	15,038	14,726
Above Normal (16%)	10,150	15,450	24,122	39,692	47,763	42,758	24,410	18,064	16,533	21,746	15,907	14,192
Below Normal (13%)	12,254	14,318	15,586	19,280	31,808	19,442	14,599	14,690	17,758	20,643	13,951	12,000
Dry (24%)	10,354	10,984	13,633	17,418	23,789	21,475	15,084	12,519	14,646	14,838	10,740	10,387
Critical (15%)	8,809	8,499	11,430	14,601	15,535	12,818	10,626	8,240	10,863	9,787	8,969	7,370

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	14,943	22,413	49,061	63,978	70,378	62,016	46,176	38,567	19,878	24,622	17,168	29,174
20%	14,024	18,968	32,387	52,720	61,625	51,028	32,558	25,925	16,015	24,044	16,812	28,630
30%	13,242	18,223	21,284	38,363	49,339	37,119	22,938	16,497	13,891	22,798	16,216	22,285
40%	12,114	16,756	17,972	24,564	42,829	29,446	19,999	13,452	13,365	20,928	15,920	21,314
50%	10,960	15,237	15,541	20,767	32,462	24,475	15,899	12,324	13,076	19,016	14,837	14,553
60%	9,175	13,091	15,097	18,151	24,481	20,699	12,818	11,385	12,593	17,772	13,961	12,554
70%	8,278	10,048	13,503	14,788	19,200	18,284	11,560	11,000	12,084	16,743	11,450	10,186
80%	7,916	8,600	10,754	13,471	16,242	14,866	10,757	10,413	11,011	15,241	9,408	8,418
90%	6,406	7,499	9,330	11,750	13,930	11,376	9,707	8,994	10,151	11,748	8,218	6,959
Long Term												
Full Simulation Period ^b	11,027	15,700	22,511	30,389	37,384	31,227	21,984	17,938	14,845	18,927	13,660	17,395
Water Year Types^c												
Wet (32%)	13,028	20,442	36,300	49,140	56,543	48,019	35,045	29,928	20,087	20,487	16,031	28,019
Above Normal (16%)	10,118	17,302	24,668	38,462	46,588	40,888	24,137	16,812	13,665	23,051	16,920	21,159
Below Normal (13%)	12,085	15,834	15,808	18,273	30,185	18,600	14,108	12,602	12,927	22,211	15,563	12,132
Dry (24%)	10,191	12,717	13,654	17,185	23,392	21,285	14,927	11,770	12,904	17,081	10,453	10,150
Critical (15%)	8,102	8,539	11,205	14,132	15,821	12,526	10,333	8,354	9,755	11,143	8,590	7,198

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	408	-69	-5,471	-857	-73	-1,638	-65	-12	-1,211	1,546	521	14,121
20%	-73	3,978	-1,994	-3,543	-414	-397	16	-1,708	-2,910	2,368	873	13,985
30%	218	4,496	-1,083	-3,216	-2,211	-4,386	9	-645	-4,070	2,378	821	8,157
40%	534	3,515	-608	-2,066	-2,892	-528	-55	-1,722	-3,156	1,498	1,142	7,383
50%	142	3,150	-65	-2,242	-828	-296	-495	-1,300	-2,512	676	1,042	1,156
60%	-855	1,866	728	-316	-253	-267	-98	-1,352	-1,974	1,119	1,954	597
70%	-741	-146	923	-217	-638	-164	-148	-916	-1,000	2,145	557	289
80%	-94	-257	-45	-15	-339	-350	-472	-461	-1,343	2,363	-360	-228
90%	-303	-38	-30	-121	-288	-111	-493	72	-1,138	1,409	-327	-157
Long Term												
Full Simulation Period ^b	-108	1,553	-669	-847	-596	-635	-195	-725	-1,907	1,601	566	5,254
Water Year Types^c												
Wet (32%)	200	1,979	-2,389	-1,235	-433	-431	-15	-253	-685	1,381	993	13,293
Above Normal (16%)	-32	1,852	547	-1,230	-1,175	-1,870	-273	-1,252	-2,868	1,304	1,014	6,966
Below Normal (13%)	-169	1,516	223	-1,007	-1,623	-842	-491	-2,088	-4,831	1,568	1,611	132
Dry (24%)	-163	1,733	22	-233	-396	-190	-157	-750	-1,742	2,243	-287	-237
Critical (15%)	-707	40	-226	-469	286	-292	-293	113	-1,108	1,357	-379	-172

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c AS defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-28-5. Sacramento River at Freepoint, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	14,535	22,483	54,532	64,835	70,451	63,654	46,241	38,579	21,089	23,075	16,647	15,053
20%	14,097	14,990	34,381	56,263	62,040	51,425	32,543	27,633	18,924	21,676	15,939	14,645
30%	13,025	13,727	22,366	41,579	51,549	41,505	22,929	17,142	17,961	20,420	15,394	14,129
40%	11,580	13,241	18,580	26,629	45,721	29,974	20,054	15,174	16,521	19,429	14,779	13,931
50%	10,818	12,087	15,606	23,009	33,290	24,771	16,394	13,624	15,588	18,340	13,795	13,397
60%	10,029	11,225	14,369	18,466	24,734	20,966	12,916	12,737	14,567	16,653	12,006	11,957
70%	9,019	10,194	12,581	15,005	19,838	18,448	11,708	11,915	13,085	14,599	10,893	9,897
80%	8,009	8,857	10,799	13,486	16,580	15,217	11,229	10,874	12,353	12,878	9,767	8,646
90%	6,709	7,537	9,360	11,871	14,217	11,487	10,200	8,922	11,289	10,339	8,546	7,115
Long Term												
Full Simulation Period ^b	11,135	14,147	23,180	31,236	37,980	31,862	22,179	18,663	16,752	17,326	13,094	12,141
Water Year Types^c												
Wet (32%)	12,828	18,463	38,689	50,375	56,977	48,450	35,060	30,181	20,772	19,106	15,038	14,726
Above Normal (16%)	10,150	15,450	24,122	39,692	47,763	42,758	24,410	18,064	16,533	21,746	15,907	14,192
Below Normal (13%)	12,254	14,318	15,586	19,280	31,808	19,442	14,599	14,690	17,758	20,643	13,951	12,000
Dry (24%)	10,354	10,984	13,633	17,418	23,789	21,475	15,084	12,519	14,646	14,838	10,740	10,387
Critical (15%)	8,809	8,499	11,430	14,601	15,535	12,818	10,626	8,240	10,863	9,787	8,969	7,370

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	14,522	22,777	54,349	64,547	70,425	63,650	46,194	38,572	19,618	24,124	16,982	15,306
20%	14,016	15,433	35,012	55,813	62,015	51,429	32,554	26,881	18,690	23,538	16,423	14,750
30%	12,928	13,874	22,439	41,575	51,558	39,917	22,941	17,225	16,622	22,859	15,633	14,073
40%	11,616	12,936	18,500	26,437	45,279	29,972	19,998	15,149	16,079	21,097	15,244	13,635
50%	10,659	12,079	15,589	22,431	33,014	24,758	16,406	13,375	15,441	19,572	14,373	13,300
60%	9,263	11,153	13,999	18,180	24,733	20,947	12,825	12,360	14,633	17,322	13,505	12,363
70%	8,269	10,294	12,891	14,734	20,406	18,647	11,997	11,712	14,169	15,486	11,575	9,959
80%	7,912	8,827	11,039	13,490	16,256	15,202	10,876	11,076	12,499	13,687	9,625	8,924
90%	6,450	7,533	9,307	11,790	14,187	11,426	10,192	9,200	11,354	10,481	8,411	6,941
Long Term												
Full Simulation Period ^b	10,882	14,066	23,134	31,069	37,948	31,691	22,137	18,659	16,634	18,450	13,425	12,156
Water Year Types^c												
Wet (32%)	12,631	18,451	38,620	50,401	56,918	48,277	35,056	30,274	21,422	19,904	15,099	14,529
Above Normal (16%)	10,011	15,687	24,282	39,084	47,607	42,363	24,359	18,074	15,986	22,756	16,372	14,207
Below Normal (13%)	11,703	14,058	15,668	19,267	31,751	19,354	14,632	14,094	15,368	22,662	16,099	13,094
Dry (24%)	10,247	10,917	13,572	17,315	23,665	21,407	15,052	12,639	14,931	16,466	10,640	10,168
Critical (15%)	8,345	8,067	11,116	14,242	15,868	12,641	10,425	8,341	10,959	10,077	8,799	7,248

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-13	294	-183	-288	-25	-4	-47	-8	-1,472	1,049	336	252
20%	-81	443	632	-451	-24	4	11	-753	-234	1,862	484	106
30%	-97	147	73	-4	8	-1,588	12	83	-1,339	2,439	239	-56
40%	36	-305	-79	-192	-442	-2	-56	-25	-442	1,668	465	-296
50%	-159	-8	-17	-578	-276	-14	12	-248	-147	1,232	578	-97
60%	-767	-72	-370	-286	-1	-19	-90	-377	67	669	1,498	406
70%	-750	100	310	-271	567	199	288	-203	1,084	887	682	62
80%	-97	-30	241	4	-325	-14	-353	202	146	810	-142	278
90%	-258	-4	-52	-81	-31	-61	-8	278	66	142	-134	-174
Long Term												
Full Simulation Period ^b	-253	-81	-46	-168	-32	-171	-42	-5	-118	1,124	332	15
Water Year Types^c												
Wet (32%)	-197	-12	-69	26	-58	-172	-4	93	650	798	60	-198
Above Normal (16%)	-140	237	161	-608	-156	-395	-51	10	-547	1,010	466	14
Below Normal (13%)	-551	-260	82	-13	-57	-88	33	-595	-2,390	2,019	2,148	1,094
Dry (24%)	-107	-67	-60	-103	-124	-68	-31	120	285	1,629	-100	-219
Critical (15%)	-464	-432	-314	-358	333	-176	-201	101	96	290	-170	-121

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-28-6. Sacramento River at Freeport, Monthly Flow

Second Basis of Comparison		Monthly Flow (cfs)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	14,535	22,483	54,532	64,835	70,451	63,654	46,241	38,579	21,089	23,075	16,647	15,053
20%	14,097	14,990	34,381	56,263	62,040	51,425	32,543	27,633	18,924	21,676	15,939	14,645
30%	13,025	13,727	22,366	41,579	51,549	41,505	22,929	17,142	17,961	20,420	15,394	14,129
40%	11,580	13,241	18,580	26,629	45,721	29,974	20,054	15,174	16,521	19,429	14,779	13,931
50%	10,818	12,087	15,606	23,009	33,290	24,771	16,394	13,624	15,588	18,340	13,795	13,397
60%	10,029	11,225	14,369	18,466	24,734	20,966	12,916	12,737	14,567	16,653	12,006	11,957
70%	9,019	10,194	12,581	15,005	19,838	18,448	11,708	11,915	13,085	14,599	10,893	9,897
80%	8,009	8,857	10,799	13,486	16,580	15,217	11,229	10,874	12,353	12,878	9,767	8,646
90%	6,709	7,537	9,360	11,871	14,217	11,487	10,200	8,922	11,289	10,339	8,546	7,115
Long Term												
Full Simulation Period ^b	11,135	14,147	23,180	31,236	37,980	31,862	22,179	18,663	16,752	17,326	13,094	12,141
Water Year Types ^c												
Wet (32%)	12,828	18,463	38,689	50,375	56,977	48,450	35,060	30,181	20,772	19,106	15,038	14,726
Above Normal (16%)	10,150	15,450	24,122	39,692	47,763	42,758	24,410	18,064	16,533	21,746	15,907	14,192
Below Normal (13%)	12,254	14,318	15,586	19,280	31,808	19,442	14,599	14,690	17,758	20,643	13,951	12,000
Dry (24%)	10,354	10,984	13,633	17,418	23,789	21,475	15,084	12,519	14,646	14,838	10,740	10,387
Critical (15%)	8,809	8,499	11,430	14,601	15,535	12,818	10,626	8,240	10,863	9,787	8,969	7,370

Alternative 5		Monthly Flow (cfs)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	14,940	22,403	48,958	63,738	70,363	62,025	46,178	38,574	19,953	24,625	17,185	29,151
20%	13,753	18,981	32,387	52,655	61,599	51,038	32,559	25,815	16,141	24,012	16,842	28,386
30%	13,111	18,329	21,304	38,363	49,567	37,212	22,950	16,490	13,942	23,249	16,214	22,293
40%	11,971	16,727	17,992	24,503	42,844	29,460	20,004	12,900	13,403	21,099	15,960	21,312
50%	10,996	15,185	15,541	20,791	32,715	24,379	15,901	11,905	13,055	19,737	15,468	14,746
60%	9,175	13,119	15,099	18,100	24,483	20,700	12,517	11,096	12,619	18,365	14,543	13,155
70%	8,302	10,026	13,584	14,777	19,202	18,200	11,777	10,131	12,094	17,451	11,864	10,306
80%	7,912	8,595	10,753	13,467	16,241	14,863	10,304	9,401	10,762	15,630	9,789	8,689
90%	6,444	7,512	9,293	11,701	13,900	11,364	9,585	8,003	10,127	11,885	8,975	7,378
Long Term												
Full Simulation Period ^b	11,003	15,715	22,497	30,404	37,388	31,223	21,901	17,523	14,824	19,224	13,951	17,409
Water Year Types ^c												
Wet (32%)	12,973	20,552	36,278	49,232	56,574	48,034	35,045	29,921	20,050	20,717	16,120	27,839
Above Normal (16%)	10,196	17,255	24,677	38,449	46,580	40,841	24,141	16,617	13,618	23,104	16,859	21,070
Below Normal (13%)	12,003	15,829	15,766	18,240	30,181	18,617	14,146	12,152	12,755	22,395	15,727	12,486
Dry (24%)	10,157	12,669	13,658	17,178	23,432	21,280	14,835	10,813	12,951	17,695	11,049	10,285
Critical (15%)	8,100	8,542	11,179	14,090	15,730	12,507	9,883	7,752	9,826	11,428	9,309	7,230

Alternative 5 minus Second Basis of Comparison		Monthly Flow (cfs)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	405	-79	-5,574	-1,097	-88	-1,629	-63	-5	-1,136	1,550	538	14,097
20%	-344	3,991	-1,994	-3,608	-441	-387	16	-1,819	-2,783	2,336	903	13,742
30%	86	4,601	-1,063	-3,216	-1,983	-4,293	21	-652	-4,019	2,829	820	8,164
40%	390	3,486	-588	-2,126	-2,877	-513	-50	-2,273	-3,118	1,670	1,181	7,381
50%	178	3,098	-65	-2,218	-575	-393	-494	-1,719	-2,533	1,397	1,672	1,349
60%	-855	1,894	730	-366	-252	-266	-399	-1,641	-1,948	1,712	2,537	1,199
70%	-716	-168	1,004	-228	-636	-247	69	-1,785	-990	2,853	971	410
80%	-97	-262	-46	-19	-339	-354	-924	-1,474	-1,591	2,752	21	43
90%	-265	-25	-67	-170	-318	-123	-615	-919	-1,162	1,545	430	263
Long Term												
Full Simulation Period ^b	-132	1,568	-683	-832	-592	-640	-278	-1,140	-1,927	1,898	857	5,268
Water Year Types ^c												
Wet (32%)	146	2,089	-2,411	-1,143	-403	-416	-15	-261	-722	1,611	1,081	13,113
Above Normal (16%)	46	1,804	555	-1,243	-1,184	-1,917	-270	-1,447	-2,914	1,358	952	6,878
Below Normal (13%)	-251	1,511	180	-1,040	-1,627	-825	-453	-2,538	-5,003	1,752	1,776	486
Dry (24%)	-197	1,685	26	-240	-357	-195	-249	-1,707	-1,695	2,858	309	-102
Critical (15%)	-709	43	-251	-511	195	-311	-743	-489	-1,037	1,641	339	-140

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1 **C.29. Yolo Bypass Flow**


Figure C-29-1. Yolo Bypass, Long-Term* Average Flow

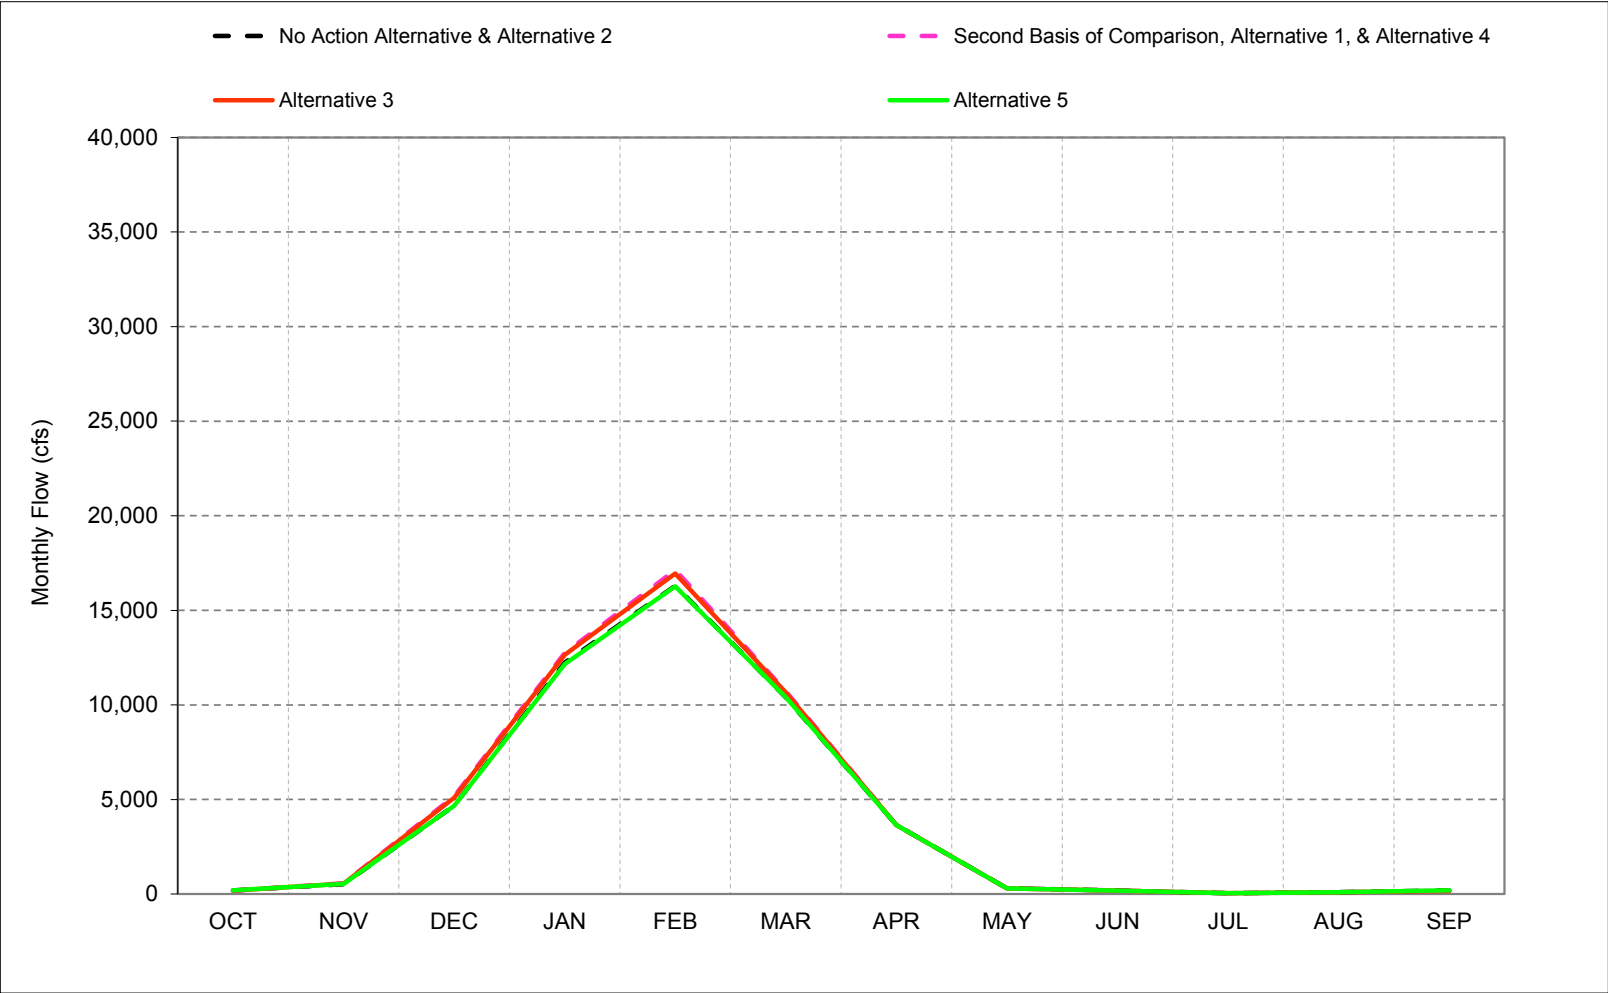

*Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-29-2. Yolo Bypass, Wet Year* Long-Term** Average Flow

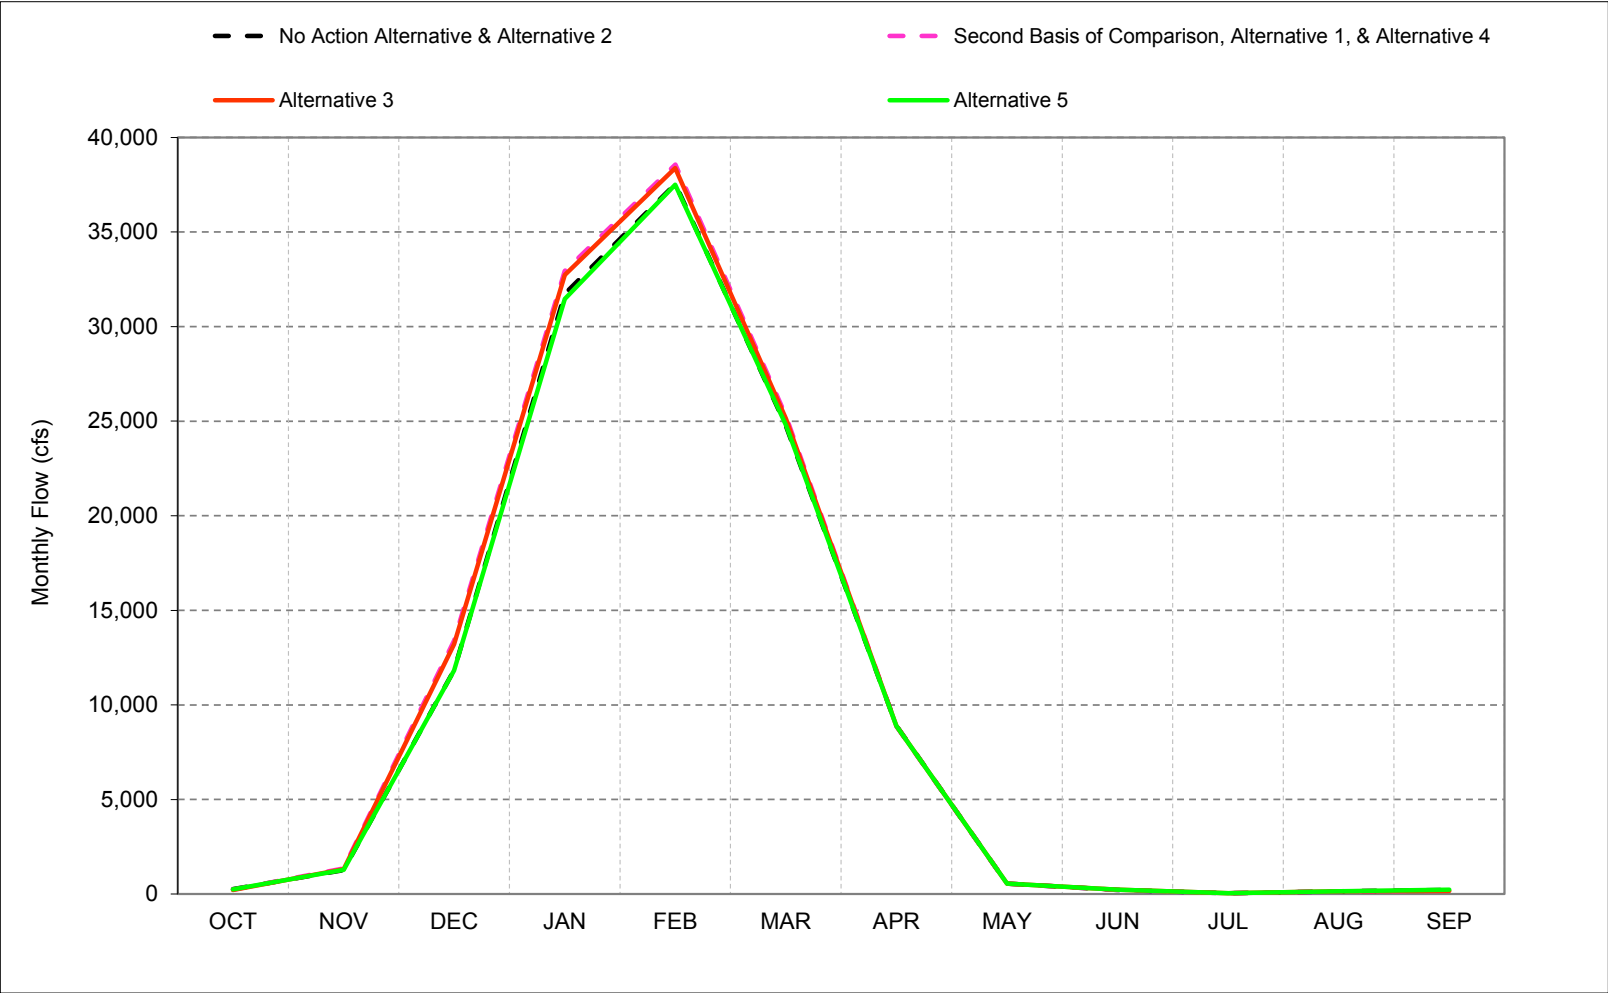


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-29-3. Yolo Bypass, Above Normal Year* Long-Term** Average Flow

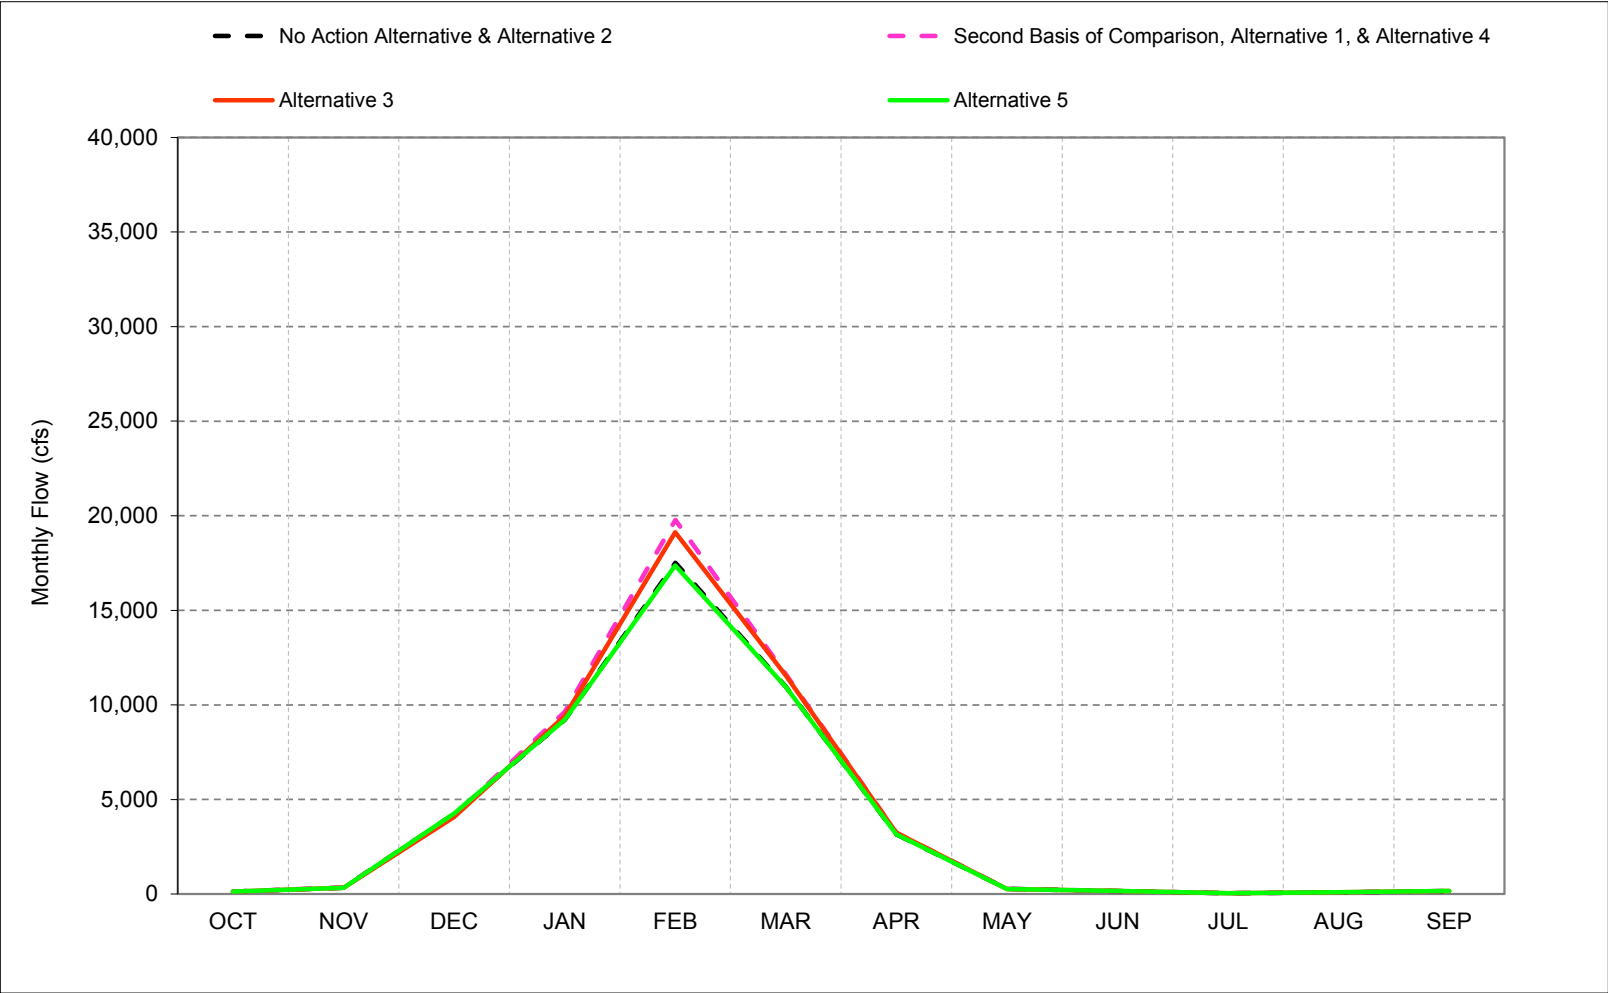


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-29-4. Yolo Bypass, Below Normal Year* Long-Term** Average Flow

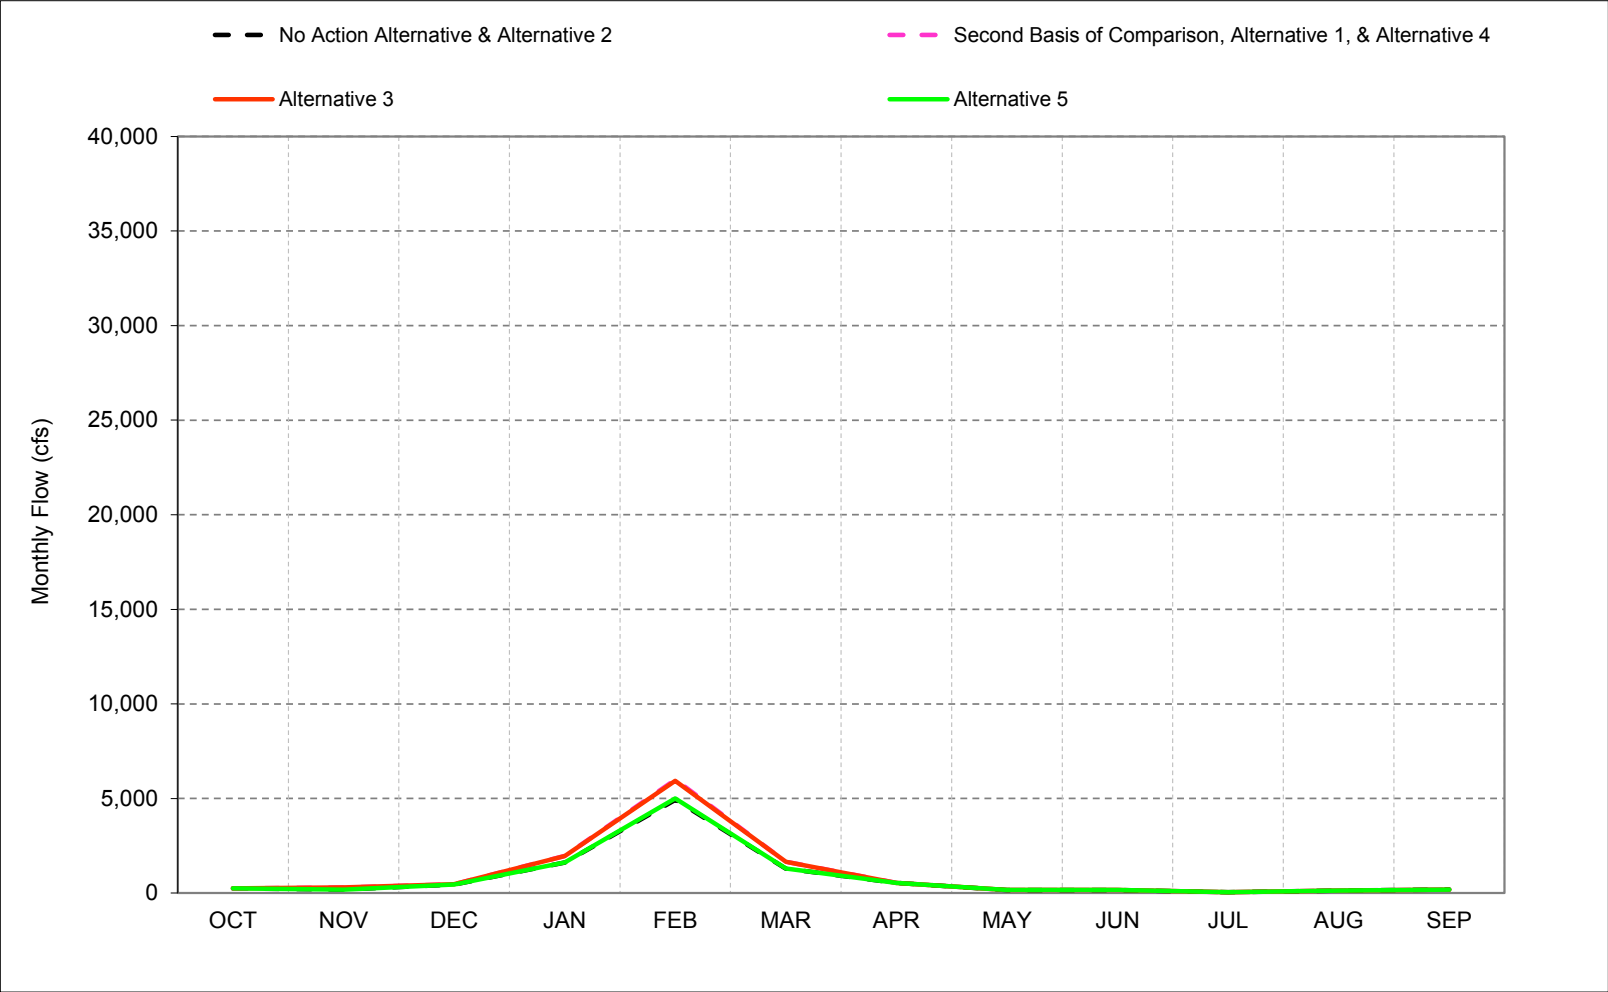


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-29-5. Yolo Bypass, Dry Year* Long-Term** Average Flow

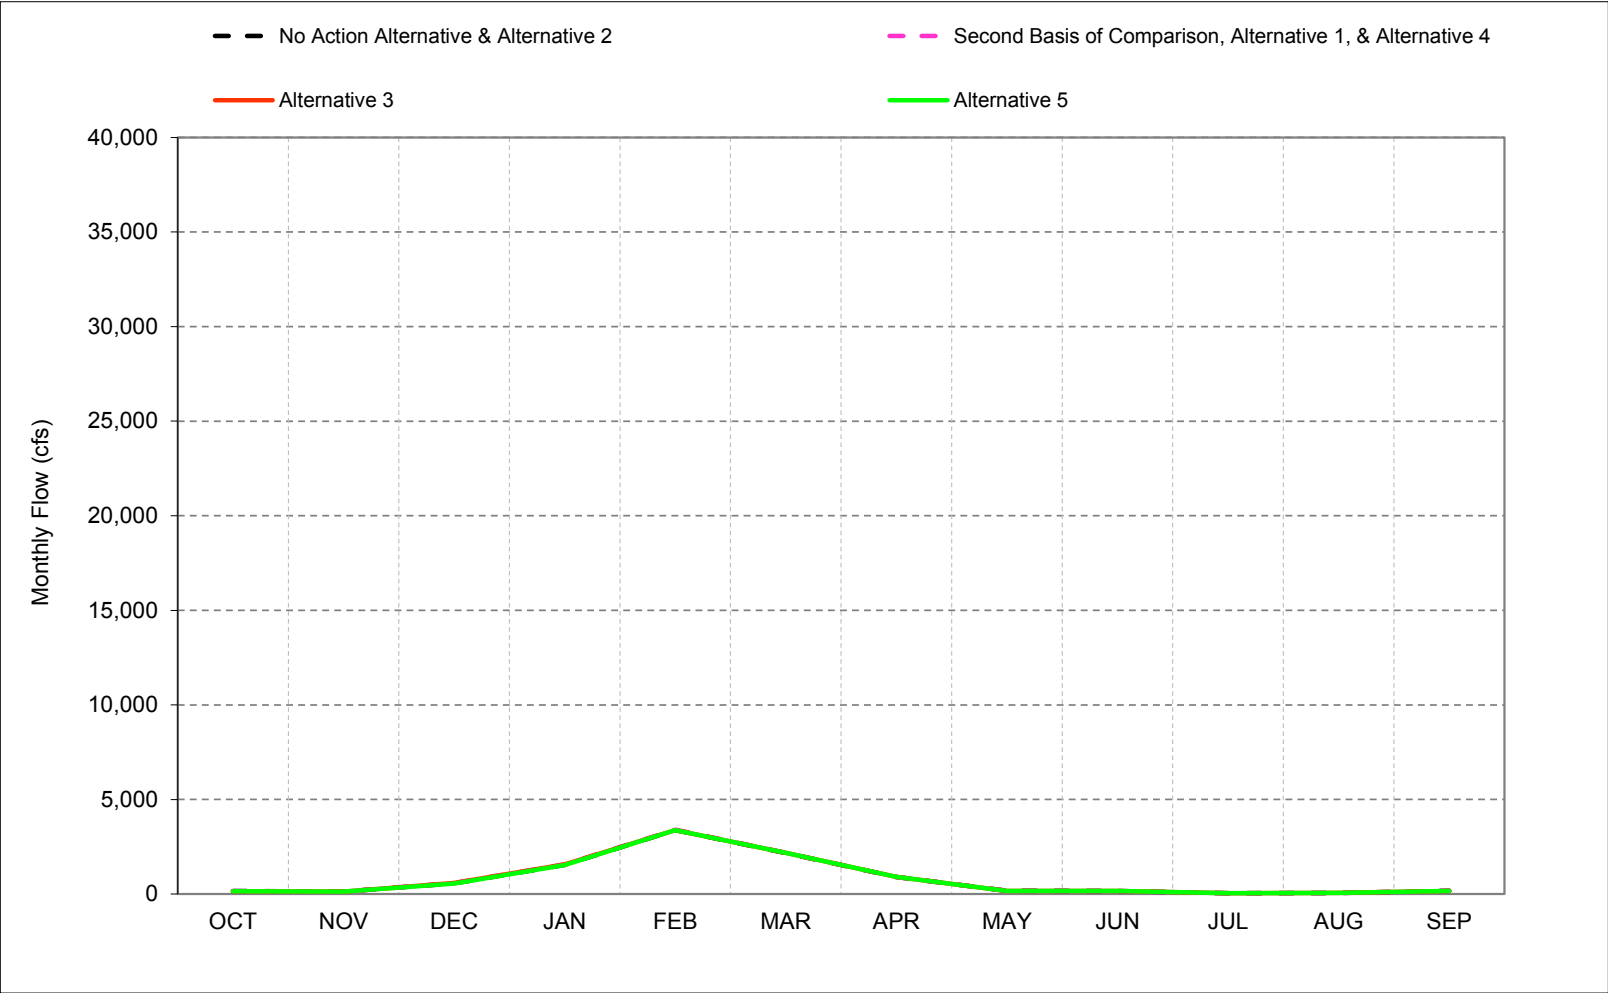


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-29-6. Yolo Bypass, Critical Year* Long-Term** Average Flow

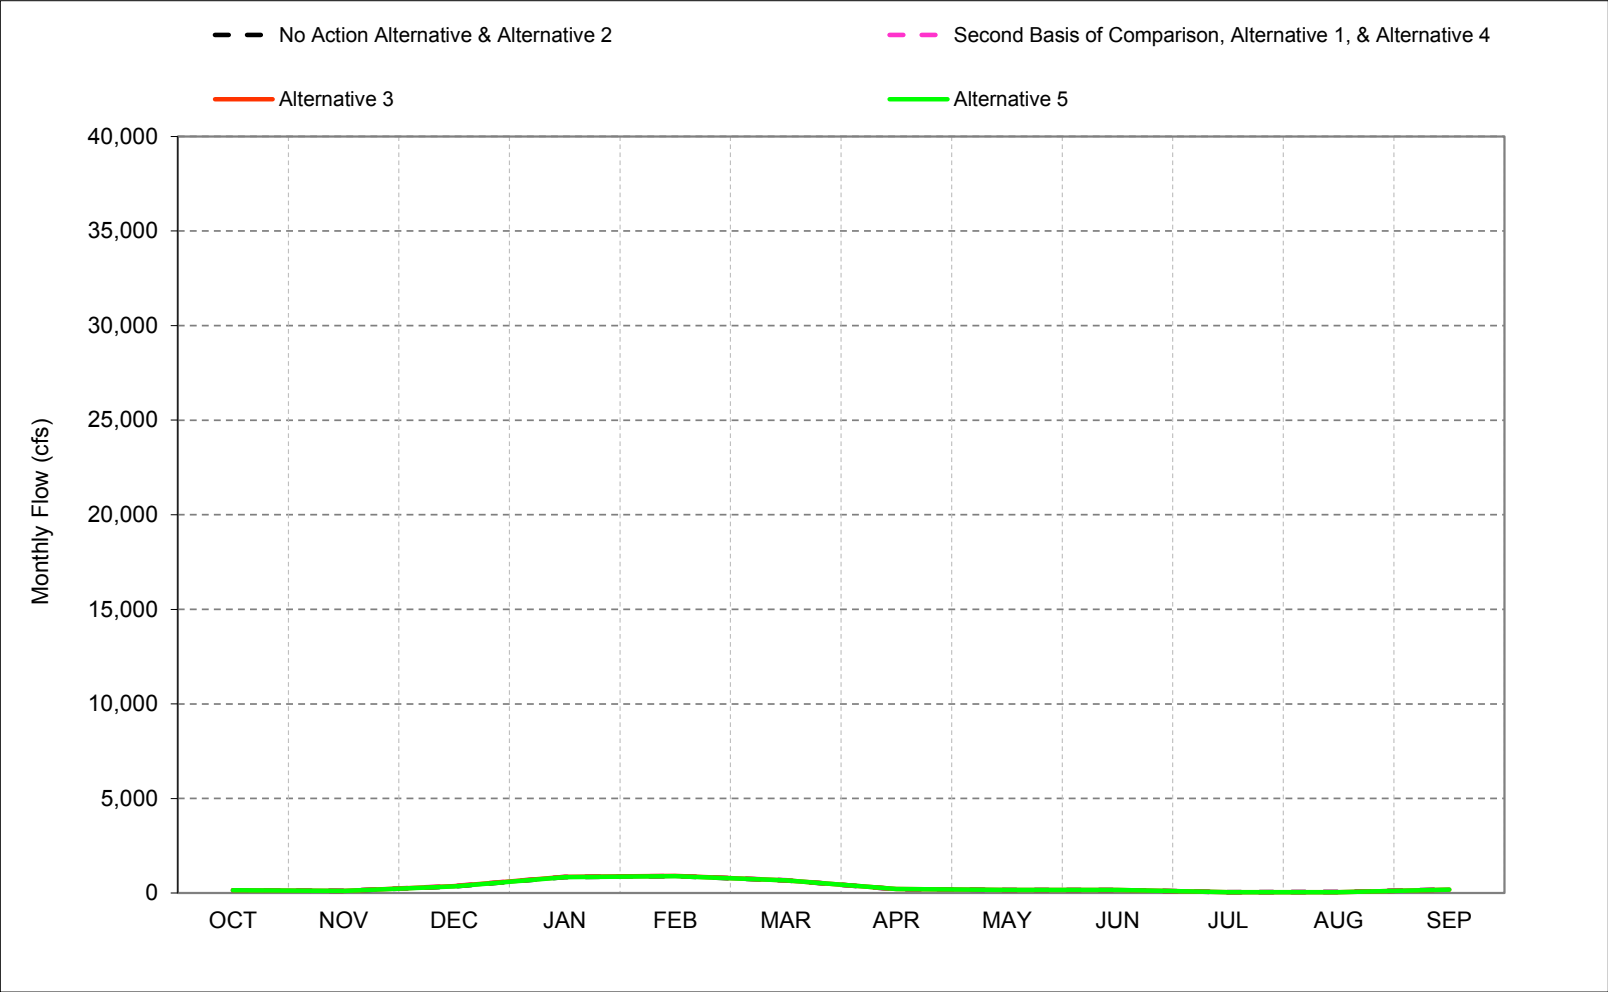

*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-29-1. Yolo Bypass, Monthly Flow

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	163	575	11,441	34,478	52,474	20,341	10,435	335	168	48	183	290
20%	162	245	6,247	15,620	20,921	10,931	7,063	178	168	48	55	194
30%	159	146	2,165	8,237	12,308	7,941	2,042	173	168	48	55	159
40%	153	110	798	4,526	8,343	4,740	497	170	168	48	55	159
50%	146	108	558	1,883	5,503	2,825	267	168	167	48	55	159
60%	141	105	258	776	2,879	1,254	229	165	167	48	55	159
70%	129	100	157	466	951	616	211	163	166	48	55	158
80%	115	100	110	164	321	220	186	159	164	48	55	156
90%	104	100	100	123	152	146	170	153	162	48	54	152
Long Term												
Full Simulation Period ^b	198	531	4,678	12,239	16,299	10,398	3,648	311	185	48	101	193
Water Year Types ^c												
Wet (32%)	269	1,266	11,844	31,732	37,542	24,774	8,899	560	227	48	147	227
Above Normal (16%)	131	337	4,234	9,213	17,513	10,972	3,165	273	166	48	92	165
Below Normal (13%)	245	192	447	1,617	4,933	1,299	547	169	166	48	130	192
Dry (24%)	156	131	569	1,540	3,384	2,173	905	175	167	48	61	170
Critical (15%)	145	124	357	847	897	675	210	167	165	48	55	188

Alternative 1

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	164	575	15,113	37,297	53,013	25,747	10,346	335	168	48	183	240
20%	162	245	6,239	16,046	22,314	11,069	7,372	178	168	48	55	159
30%	160	146	2,510	8,216	12,519	8,557	2,043	173	168	48	55	159
40%	154	110	802	5,019	10,224	5,190	498	170	168	48	55	159
50%	147	108	495	2,405	5,513	2,987	272	168	167	48	55	159
60%	142	105	259	970	3,258	1,402	229	165	167	48	55	159
70%	132	100	146	470	1,068	754	211	163	166	48	55	157
80%	116	100	109	167	332	225	186	159	164	48	55	155
90%	106	100	100	122	152	149	173	153	162	48	54	152
Long Term												
Full Simulation Period ^b	187	572	5,169	12,745	17,130	10,720	3,653	311	185	48	101	175
Water Year Types ^c												
Wet (32%)	231	1,348	13,405	32,933	38,563	25,293	8,874	560	227	48	147	173
Above Normal (16%)	137	344	4,156	9,639	19,777	11,623	3,242	273	166	48	92	165
Below Normal (13%)	246	299	470	1,973	5,998	1,664	546	169	166	48	130	192
Dry (24%)	156	131	583	1,579	3,404	2,190	910	175	167	48	61	170
Critical (15%)	145	124	376	856	905	687	210	167	165	48	55	188

Alternative 1 minus No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1	0	3,672	2,819	539	5,406	-89	0	0	0	0	-50
20%	1	0	-8	426	1,394	138	309	0	0	0	0	-35
30%	1	0	345	-21	211	616	1	0	0	0	0	0
40%	0	0	3	493	1,881	450	0	0	0	0	0	0
50%	2	0	-63	522	10	163	4	0	0	0	0	0
60%	1	0	1	194	379	148	0	0	0	0	0	-1
70%	3	0	-11	4	118	138	0	0	0	0	0	-1
80%	1	0	-1	3	12	6	0	0	0	0	0	-1
90%	2	0	0	-1	0	3	3	0	0	0	0	0
Long Term												
Full Simulation Period ^b	-11	42	492	507	831	323	5	0	0	0	0	-17
Water Year Types ^c												
Wet (32%)	-38	82	1,561	1,201	1,020	519	-25	0	0	0	0	-55
Above Normal (16%)	6	7	-78	426	2,264	651	77	0	0	0	0	0
Below Normal (13%)	1	108	23	356	1,065	365	-1	0	0	0	0	0
Dry (24%)	0	0	14	39	20	17	4	0	0	0	0	0
Critical (15%)	0	0	19	9	7	12	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-29-2. Yolo Bypass, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	163	575	11,441	34,478	52,474	20,341	10,435	335	168	48	183	290
20%	162	245	6,247	15,620	20,921	10,931	7,063	178	168	48	55	194
30%	159	146	2,165	8,237	12,308	7,941	2,042	173	168	48	55	159
40%	153	110	798	4,526	8,343	4,740	497	170	168	48	55	159
50%	146	108	558	1,883	5,503	2,825	267	168	167	48	55	159
60%	141	105	258	776	2,879	1,254	229	165	167	48	55	159
70%	129	100	157	466	951	616	211	163	166	48	55	158
80%	115	100	110	164	321	220	186	159	164	48	55	156
90%	104	100	100	123	152	146	170	153	162	48	54	152
Long Term												
Full Simulation Period ^b	198	531	4,678	12,239	16,299	10,398	3,648	311	185	48	101	193
Water Year Types^c												
Wet (32%)	269	1,266	11,844	31,732	37,542	24,774	8,899	560	227	48	147	227
Above Normal (16%)	131	337	4,234	9,213	17,513	10,972	3,165	273	166	48	92	165
Below Normal (13%)	245	192	447	1,617	4,933	1,299	547	169	166	48	130	192
Dry (24%)	156	131	569	1,540	3,384	2,173	905	175	167	48	61	170
Critical (15%)	145	124	357	847	897	675	210	167	165	48	55	188

Alternative 3												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	163	575	15,105	36,977	52,994	23,562	10,346	335	168	48	183	240
20%	162	245	6,398	16,162	20,780	10,937	7,383	178	168	48	55	159
30%	159	146	2,014	8,057	12,403	8,314	2,042	173	168	48	55	159
40%	153	110	802	5,022	10,223	5,060	498	170	168	48	55	159
50%	146	108	496	2,336	5,513	2,933	272	168	167	48	55	159
60%	141	105	287	945	2,888	1,421	229	165	167	48	55	159
70%	129	100	149	466	1,114	738	211	163	166	48	55	157
80%	116	100	114	166	323	220	186	159	164	48	55	155
90%	104	100	100	123	152	149	170	153	162	48	54	152
Long Term												
Full Simulation Period ^b	184	564	5,096	12,644	16,954	10,652	3,658	311	185	48	101	175
Water Year Types^c												
Wet (32%)	223	1,325	13,210	32,736	38,378	25,127	8,889	561	227	48	147	173
Above Normal (16%)	132	338	4,083	9,412	19,135	11,550	3,246	273	166	48	92	165
Below Normal (13%)	246	299	471	1,968	5,929	1,651	546	169	166	48	130	192
Dry (24%)	156	131	590	1,571	3,376	2,186	908	175	167	48	61	170
Critical (15%)	145	124	365	856	908	676	210	167	165	48	55	188

Alternative 3 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	3,663	2,500	520	3,221	-89	0	0	0	0	-50
20%	0	0	151	542	-140	6	321	0	0	0	0	-35
30%	0	0	-150	-180	95	373	0	0	0	0	0	0
40%	0	0	4	496	1,881	320	1	0	0	0	0	0
50%	0	0	-62	453	10	108	4	0	0	0	0	0
60%	0	0	29	169	9	167	0	0	0	0	0	-1
70%	1	0	-8	0	163	122	0	0	0	0	0	-1
80%	1	0	3	3	2	0	0	0	0	0	0	-1
90%	0	0	0	0	0	3	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	-14	33	419	406	655	254	10	0	0	0	0	-17
Water Year Types^c												
Wet (32%)	-46	59	1,366	1,004	836	353	-10	1	0	0	0	-55
Above Normal (16%)	1	1	-151	198	1,622	579	80	0	0	0	0	0
Below Normal (13%)	1	108	24	351	996	352	-1	0	0	0	0	0
Dry (24%)	1	0	21	30	-8	13	3	0	0	0	0	0
Critical (15%)	0	0	8	9	11	1	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-29-3. Yolo Bypass, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	163	575	11,441	34,478	52,474	20,341	10,435	335	168	48	183	290
20%	162	245	6,247	15,620	20,921	10,931	7,063	178	168	48	55	194
30%	159	146	2,165	8,237	12,308	7,941	2,042	173	168	48	55	159
40%	153	110	798	4,526	8,343	4,740	497	170	168	48	55	159
50%	146	108	558	1,883	5,503	2,825	267	168	167	48	55	159
60%	141	105	258	776	2,879	1,254	229	165	167	48	55	159
70%	129	100	157	466	951	616	211	163	166	48	55	158
80%	115	100	110	164	321	220	186	159	164	48	55	156
90%	104	100	100	123	152	146	170	153	162	48	54	152
Long Term												
Full Simulation Period ^b	198	531	4,678	12,239	16,299	10,398	3,648	311	185	48	101	193
Water Year Types^c												
Wet (32%)	269	1,266	11,844	31,732	37,542	24,774	8,899	560	227	48	147	227
Above Normal (16%)	131	337	4,234	9,213	17,513	10,972	3,165	273	166	48	92	165
Below Normal (13%)	245	192	447	1,617	4,933	1,299	547	169	166	48	130	192
Dry (24%)	156	131	569	1,540	3,384	2,173	905	175	167	48	61	170
Critical (15%)	145	124	357	847	897	675	210	167	165	48	55	188

Alternative 5												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	163	575	11,727	33,139	52,516	20,378	10,436	335	168	48	183	290
20%	162	245	6,221	15,644	20,577	10,932	7,063	178	168	48	55	194
30%	159	146	2,160	8,237	12,384	8,053	2,042	173	168	48	55	159
40%	153	110	824	4,526	8,343	4,746	497	170	168	48	55	159
50%	146	108	533	1,874	5,503	2,793	267	168	167	48	55	159
60%	141	105	258	770	2,873	1,250	229	165	167	48	55	159
70%	129	100	157	466	951	616	211	163	166	48	55	158
80%	115	100	106	164	321	220	186	159	164	48	55	156
90%	104	100	100	126	150	146	170	153	162	48	54	152
Long Term												
Full Simulation Period ^b	194	538	4,670	12,152	16,274	10,399	3,649	311	185	48	101	193
Water Year Types^c												
Wet (32%)	255	1,289	11,815	31,464	37,505	24,793	8,899	560	227	48	147	227
Above Normal (16%)	131	337	4,256	9,217	17,377	10,938	3,165	273	166	48	92	165
Below Normal (13%)	245	192	451	1,617	5,013	1,302	546	169	166	48	130	192
Dry (24%)	156	131	556	1,533	3,378	2,177	906	175	167	48	61	170
Critical (15%)	145	124	359	846	897	673	210	167	165	48	55	188

Alternative 5 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	285	-1,339	42	37	1	0	0	0	0	0
20%	0	0	-26	24	-343	0	1	0	0	0	0	0
30%	0	0	-5	-1	76	112	0	0	0	0	0	0
40%	0	0	26	0	0	6	0	0	0	0	0	0
50%	0	0	-25	-9	0	-32	0	0	0	0	0	0
60%	0	0	0	-7	-7	-4	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	-5	0	0	0	0	0	0	0	0	0
90%	0	0	0	3	-2	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	-4	7	-8	-86	-24	2	0	0	0	0	0	0
Water Year Types^c												
Wet (32%)	-14	23	-29	-268	-37	19	0	0	0	0	0	0
Above Normal (16%)	0	0	22	4	-137	-33	0	0	0	0	0	0
Below Normal (13%)	0	0	4	0	81	3	0	0	0	0	0	0
Dry (24%)	0	0	-13	-7	-7	4	0	0	0	0	0	0
Critical (15%)	0	0	1	0	-1	-3	0	0	0	0	0	0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-29-4. Yolo Bypass, Monthly Flow

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance^a												
10%	164	575	15,113	37,297	53,013	25,747	10,346	335	168	48	183	240
20%	162	245	6,239	16,046	22,314	11,069	7,372	178	168	48	55	159
30%	160	146	2,510	8,216	12,519	8,557	2,043	173	168	48	55	159
40%	154	110	802	5,019	10,224	5,190	498	170	168	48	55	159
50%	147	108	495	2,405	5,513	2,987	272	168	167	48	55	159
60%	142	105	259	970	3,258	1,402	229	165	167	48	55	159
70%	132	100	146	470	1,068	754	211	163	166	48	55	157
80%	116	100	109	167	332	225	186	159	164	48	55	155
90%	106	100	100	122	152	149	173	153	162	48	54	152
Long Term												
Full Simulation Period ^b	187	572	5,169	12,745	17,130	10,720	3,653	311	185	48	101	175
Water Year Types^c												
Wet (32%)	231	1,348	13,405	32,933	38,563	25,293	8,874	560	227	48	147	173
Above Normal (16%)	137	344	4,156	9,639	19,777	11,623	3,242	273	166	48	92	165
Below Normal (13%)	246	299	470	1,973	5,998	1,664	546	169	166	48	130	192
Dry (24%)	156	131	583	1,579	3,404	2,190	910	175	167	48	61	170
Critical (15%)	145	124	376	856	905	687	210	167	165	48	55	188

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance^a												
10%	163	575	11,441	34,478	52,474	20,341	10,435	335	168	48	183	290
20%	162	245	6,247	15,620	20,921	10,931	7,063	178	168	48	55	194
30%	159	146	2,165	8,237	12,308	7,941	2,042	173	168	48	55	159
40%	153	110	798	4,526	8,343	4,740	497	170	168	48	55	159
50%	146	108	558	1,883	5,503	2,825	267	168	167	48	55	159
60%	141	105	258	776	2,879	1,254	229	165	167	48	55	159
70%	129	100	157	466	951	616	211	163	166	48	55	158
80%	115	100	110	164	321	220	186	159	164	48	55	156
90%	104	100	100	123	152	146	170	153	162	48	54	152
Long Term												
Full Simulation Period ^b	198	531	4,678	12,239	16,299	10,398	3,648	311	185	48	101	193
Water Year Types^c												
Wet (32%)	269	1,266	11,844	31,732	37,542	24,774	8,899	560	227	48	147	227
Above Normal (16%)	131	337	4,234	9,213	17,513	10,972	3,165	273	166	48	92	165
Below Normal (13%)	245	192	447	1,617	4,933	1,299	547	169	166	48	130	192
Dry (24%)	156	131	569	1,540	3,384	2,173	905	175	167	48	61	170
Critical (15%)	145	124	357	847	897	675	210	167	165	48	55	188

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative minus Second Basis of Comparison												
Probability of Exceedance^a												
10%	-1	0	-3,672	-2,819	-539	-5,406	89	0	0	0	0	50
20%	-1	0	8	-426	-1,394	-138	-309	0	0	0	0	35
30%	-1	0	-345	21	-211	-616	-1	0	0	0	0	0
40%	0	0	-3	-493	-1,881	-450	0	0	0	0	0	0
50%	-2	0	63	-522	-10	-163	-4	0	0	0	0	0
60%	-1	0	-1	-194	-379	-148	0	0	0	0	0	1
70%	-3	0	11	-4	-118	-138	0	0	0	0	0	1
80%	-1	0	1	-3	-12	-6	0	0	0	0	0	1
90%	-2	0	0	1	0	-3	-3	0	0	0	0	0
Long Term												
Full Simulation Period ^b	11	-42	-492	-507	-831	-323	-5	0	0	0	0	17
Water Year Types^c												
Wet (32%)	38	-82	-1,561	-1,201	-1,020	-519	25	0	0	0	0	55
Above Normal (16%)	-6	-7	78	-426	-2,264	-651	-77	0	0	0	0	0
Below Normal (13%)	-1	-108	-23	-356	-1,065	-365	1	0	0	0	0	0
Dry (24%)	0	0	-14	-39	-20	-17	-4	0	0	0	0	0
Critical (15%)	0	0	-19	-9	-7	-12	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-29-5. Yolo Bypass, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	164	575	15,113	37,297	53,013	25,747	10,346	335	168	48	183	240
20%	162	245	6,239	16,046	22,314	11,069	7,372	178	168	48	55	159
30%	160	146	2,510	8,216	12,519	8,557	2,043	173	168	48	55	159
40%	154	110	802	5,019	10,224	5,190	498	170	168	48	55	159
50%	147	108	495	2,405	5,513	2,987	272	168	167	48	55	159
60%	142	105	259	970	3,258	1,402	229	165	167	48	55	159
70%	132	100	146	470	1,068	754	211	163	166	48	55	157
80%	116	100	109	167	332	225	186	159	164	48	55	155
90%	106	100	100	122	152	149	173	153	162	48	54	152
Long Term												
Full Simulation Period ^b	187	572	5,169	12,745	17,130	10,720	3,653	311	185	48	101	175
Water Year Types ^c												
Wet (32%)	231	1,348	13,405	32,933	38,563	25,293	8,874	560	227	48	147	173
Above Normal (16%)	137	344	4,156	9,639	19,777	11,623	3,242	273	166	48	92	165
Below Normal (13%)	246	299	470	1,973	5,998	1,664	546	169	166	48	130	192
Dry (24%)	156	131	583	1,579	3,404	2,190	910	175	167	48	61	170
Critical (15%)	145	124	376	856	905	687	210	167	165	48	55	188

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	163	575	15,105	36,977	52,994	23,562	10,346	335	168	48	183	240
20%	162	245	6,398	16,162	20,780	10,937	7,383	178	168	48	55	159
30%	159	146	2,014	8,057	12,403	8,314	2,042	173	168	48	55	159
40%	153	110	802	5,022	10,223	5,060	498	170	168	48	55	159
50%	146	108	496	2,336	5,513	2,933	272	168	167	48	55	159
60%	141	105	287	945	2,888	1,421	229	165	167	48	55	159
70%	129	100	149	466	1,114	738	211	163	166	48	55	157
80%	116	100	114	166	323	220	186	159	164	48	55	155
90%	104	100	100	123	152	149	170	153	162	48	54	152
Long Term												
Full Simulation Period ^b	184	564	5,096	12,644	16,954	10,652	3,658	311	185	48	101	175
Water Year Types ^c												
Wet (32%)	223	1,325	13,210	32,736	38,378	25,127	8,889	561	227	48	147	173
Above Normal (16%)	132	338	4,083	9,412	19,135	11,550	3,246	273	166	48	92	165
Below Normal (13%)	246	299	471	1,968	5,929	1,651	546	169	166	48	130	192
Dry (24%)	156	131	590	1,571	3,376	2,186	908	175	167	48	61	170
Critical (15%)	145	124	365	856	908	676	210	167	165	48	55	188

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-1	0	-8	-319	-19	-2,185	0	0	0	0	0	0
20%	-1	0	159	116	-1,534	-131	11	0	0	0	0	0
30%	-1	0	-495	-159	-116	-243	-1	0	0	0	0	0
40%	0	0	1	3	0	-130	1	0	0	0	0	0
50%	-2	0	1	-68	0	-55	0	0	0	0	0	0
60%	-1	0	28	-24	-370	19	0	0	0	0	0	0
70%	-3	0	3	-4	45	-16	0	0	0	0	0	0
80%	0	0	4	-1	-9	-6	0	0	0	0	0	0
90%	-2	0	0	2	0	0	-3	0	0	0	0	0
Long Term												
Full Simulation Period ^b	-3	-8	-73	-101	-176	-68	5	0	0	0	0	0
Water Year Types ^c												
Wet (32%)	-8	-23	-195	-197	-185	-166	15	0	0	0	0	0
Above Normal (16%)	-5	-6	-73	-228	-642	-72	4	0	0	0	0	0
Below Normal (13%)	0	0	0	-5	-69	-13	0	0	0	0	0	0
Dry (24%)	1	0	7	-9	-28	-4	-2	0	0	0	0	0
Critical (15%)	0	0	-11	0	4	-11	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-29-6. Yolo Bypass, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	164	575	15,113	37,297	53,013	25,747	10,346	335	168	48	183	240
20%	162	245	6,239	16,046	22,314	11,069	7,372	178	168	48	55	159
30%	160	146	2,510	8,216	12,519	8,557	2,043	173	168	48	55	159
40%	154	110	802	5,019	10,224	5,190	498	170	168	48	55	159
50%	147	108	495	2,405	5,513	2,987	272	168	167	48	55	159
60%	142	105	259	970	3,258	1,402	229	165	167	48	55	159
70%	132	100	146	470	1,068	754	211	163	166	48	55	157
80%	116	100	109	167	332	225	186	159	164	48	55	155
90%	106	100	100	122	152	149	173	153	162	48	54	152
Long Term												
Full Simulation Period ^b	187	572	5,169	12,745	17,130	10,720	3,653	311	185	48	101	175
Water Year Types^c												
Wet (32%)	231	1,348	13,405	32,933	38,563	25,293	8,874	560	227	48	147	173
Above Normal (16%)	137	344	4,156	9,639	19,777	11,623	3,242	273	166	48	92	165
Below Normal (13%)	246	299	470	1,973	5,998	1,664	546	169	166	48	130	192
Dry (24%)	156	131	583	1,579	3,404	2,190	910	175	167	48	61	170
Critical (15%)	145	124	376	856	905	687	210	167	165	48	55	188

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	163	575	11,727	33,139	52,516	20,378	10,436	335	168	48	183	290
20%	162	245	6,221	15,644	20,577	10,932	7,063	178	168	48	55	194
30%	159	146	2,160	8,237	12,384	8,053	2,042	173	168	48	55	159
40%	153	110	824	4,526	8,343	4,746	497	170	168	48	55	159
50%	146	108	533	1,874	5,503	2,793	267	168	167	48	55	159
60%	141	105	258	770	2,873	1,250	229	165	167	48	55	159
70%	129	100	157	466	951	616	211	163	166	48	55	158
80%	115	100	106	164	321	220	186	159	164	48	55	156
90%	104	100	100	126	150	146	170	153	162	48	54	152
Long Term												
Full Simulation Period ^b	194	538	4,670	12,152	16,274	10,399	3,649	311	185	48	101	193
Water Year Types^c												
Wet (32%)	255	1,289	11,815	31,464	37,505	24,793	8,899	560	227	48	147	227
Above Normal (16%)	131	337	4,256	9,217	17,377	10,938	3,165	273	166	48	92	165
Below Normal (13%)	245	192	451	1,617	5,013	1,302	546	169	166	48	130	192
Dry (24%)	156	131	556	1,533	3,378	2,177	906	175	167	48	61	170
Critical (15%)	145	124	359	846	897	673	210	167	165	48	55	188

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-1	0	-3,386	-4,158	-497	-5,369	90	0	0	0	0	50
20%	-1	0	-17	-402	-1,737	-137	-309	0	0	0	0	35
30%	-1	0	-350	20	-135	-504	-1	0	0	0	0	0
40%	0	0	22	-493	-1,880	-444	0	0	0	0	0	0
50%	-2	0	38	-530	-9	-194	-4	0	0	0	0	0
60%	-1	0	-1	-200	-386	-152	0	0	0	0	0	1
70%	-3	0	11	-4	-118	-138	0	0	0	0	0	1
80%	-1	0	-4	-3	-12	-6	0	0	0	0	0	1
90%	-2	0	0	4	-2	-3	-3	0	0	0	0	0
Long Term												
Full Simulation Period ^b	6	-34	-500	-593	-856	-321	-5	0	0	0	0	17
Water Year Types^c												
Wet (32%)	24	-59	-1,590	-1,468	-1,057	-500	26	0	0	0	0	55
Above Normal (16%)	-6	-7	100	-422	-2,401	-684	-77	0	0	0	0	0
Below Normal (13%)	-1	-108	-19	-355	-984	-362	1	0	0	0	0	0
Dry (24%)	0	0	-27	-46	-26	-13	-4	0	0	0	0	0
Critical (15%)	0	0	-18	-9	-8	-15	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1 **C.30. Sacramento River Flow at Rio Vista**


Figure C-30-1. Sacramento River at Rio Vista, Long-Term* Average Flow

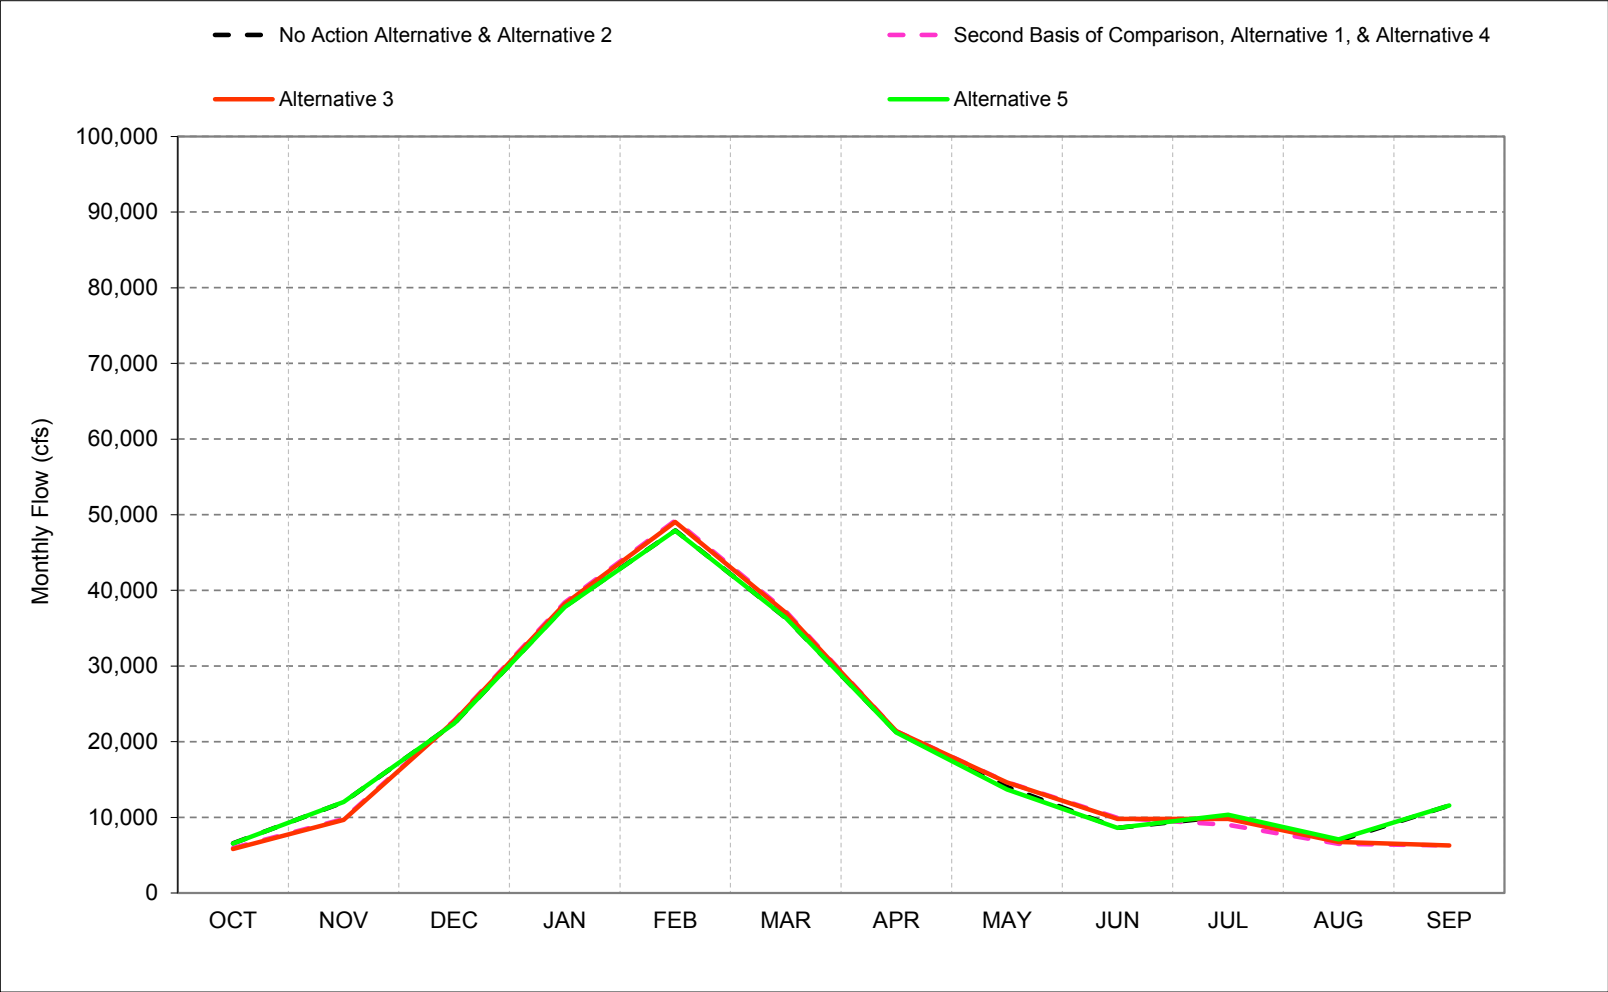

*Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-30-2. Sacramento River at Rio Vista, Wet Year* Long-Term** Average Flow

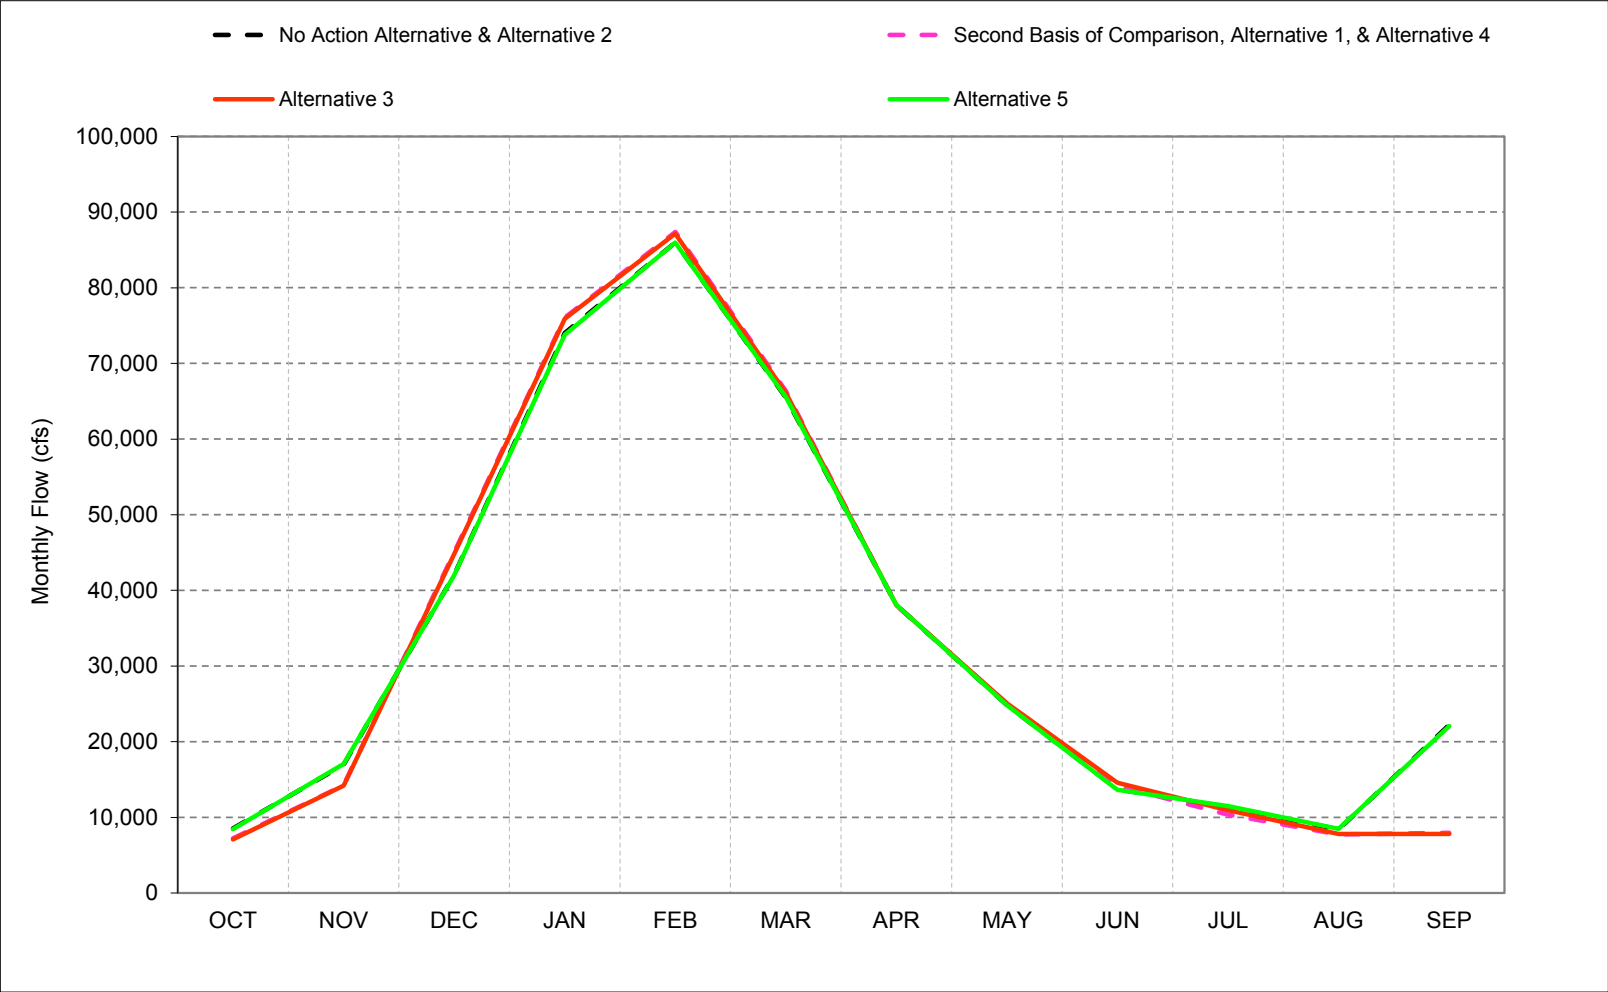


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-30-3. Sacramento River at Rio Vista, Above Normal Year* Long-Term** Average Flow

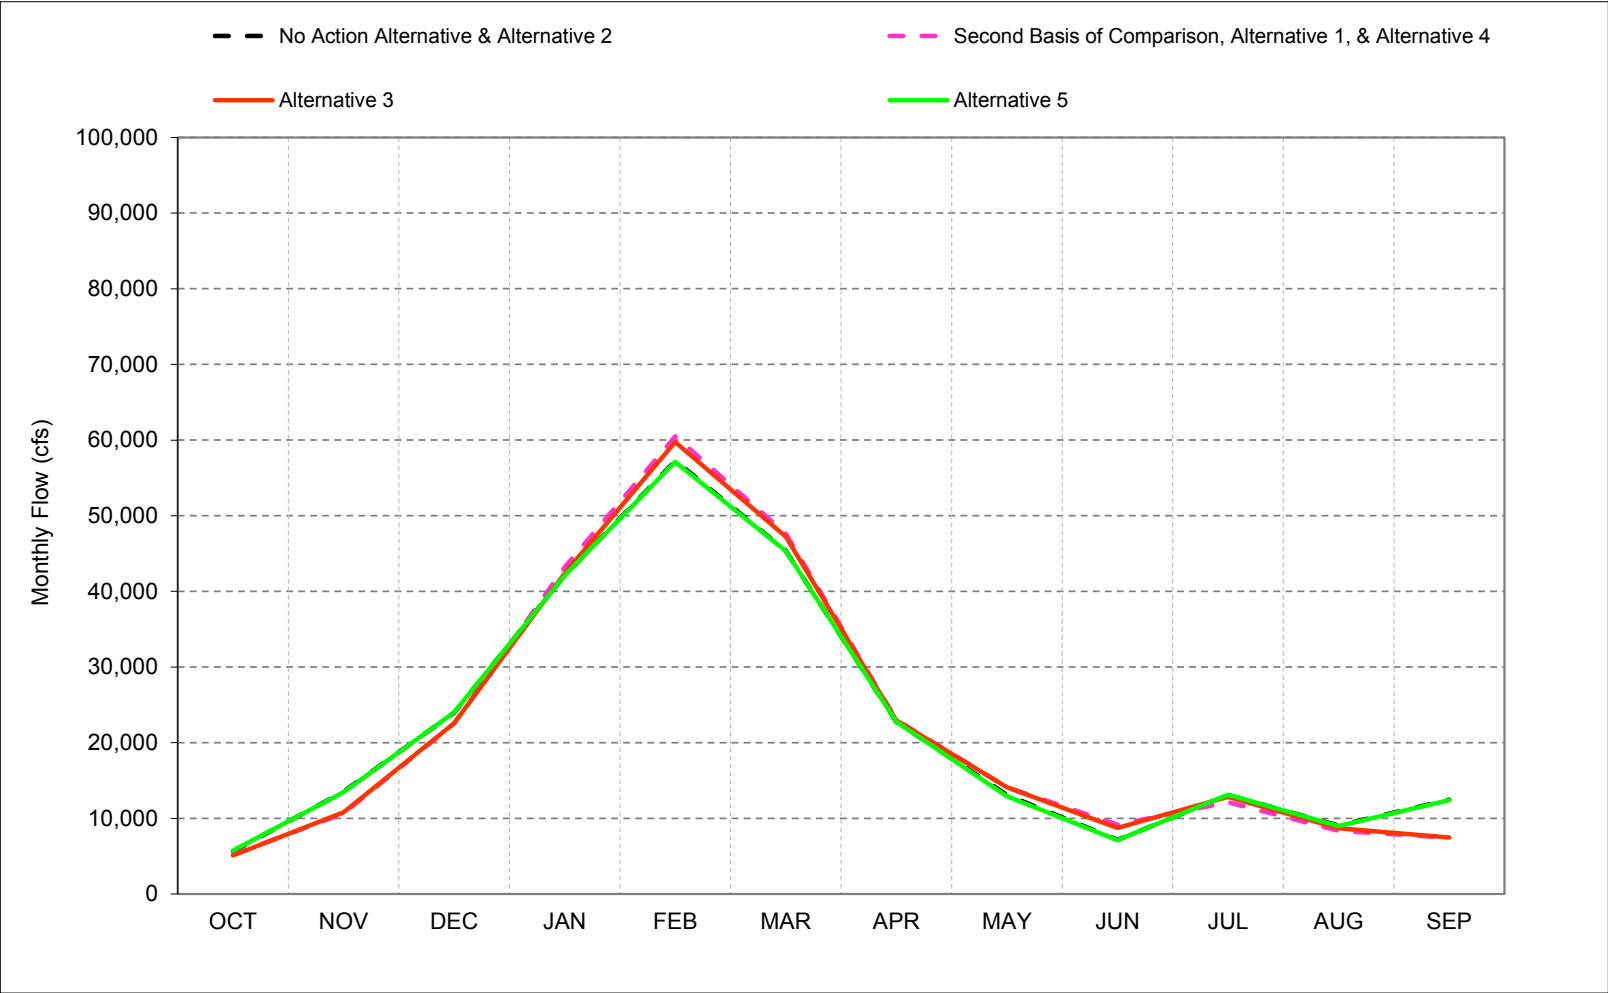


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-30-4. Sacramento River at Rio Vista, Below Normal Year* Long-Term** Average Flow

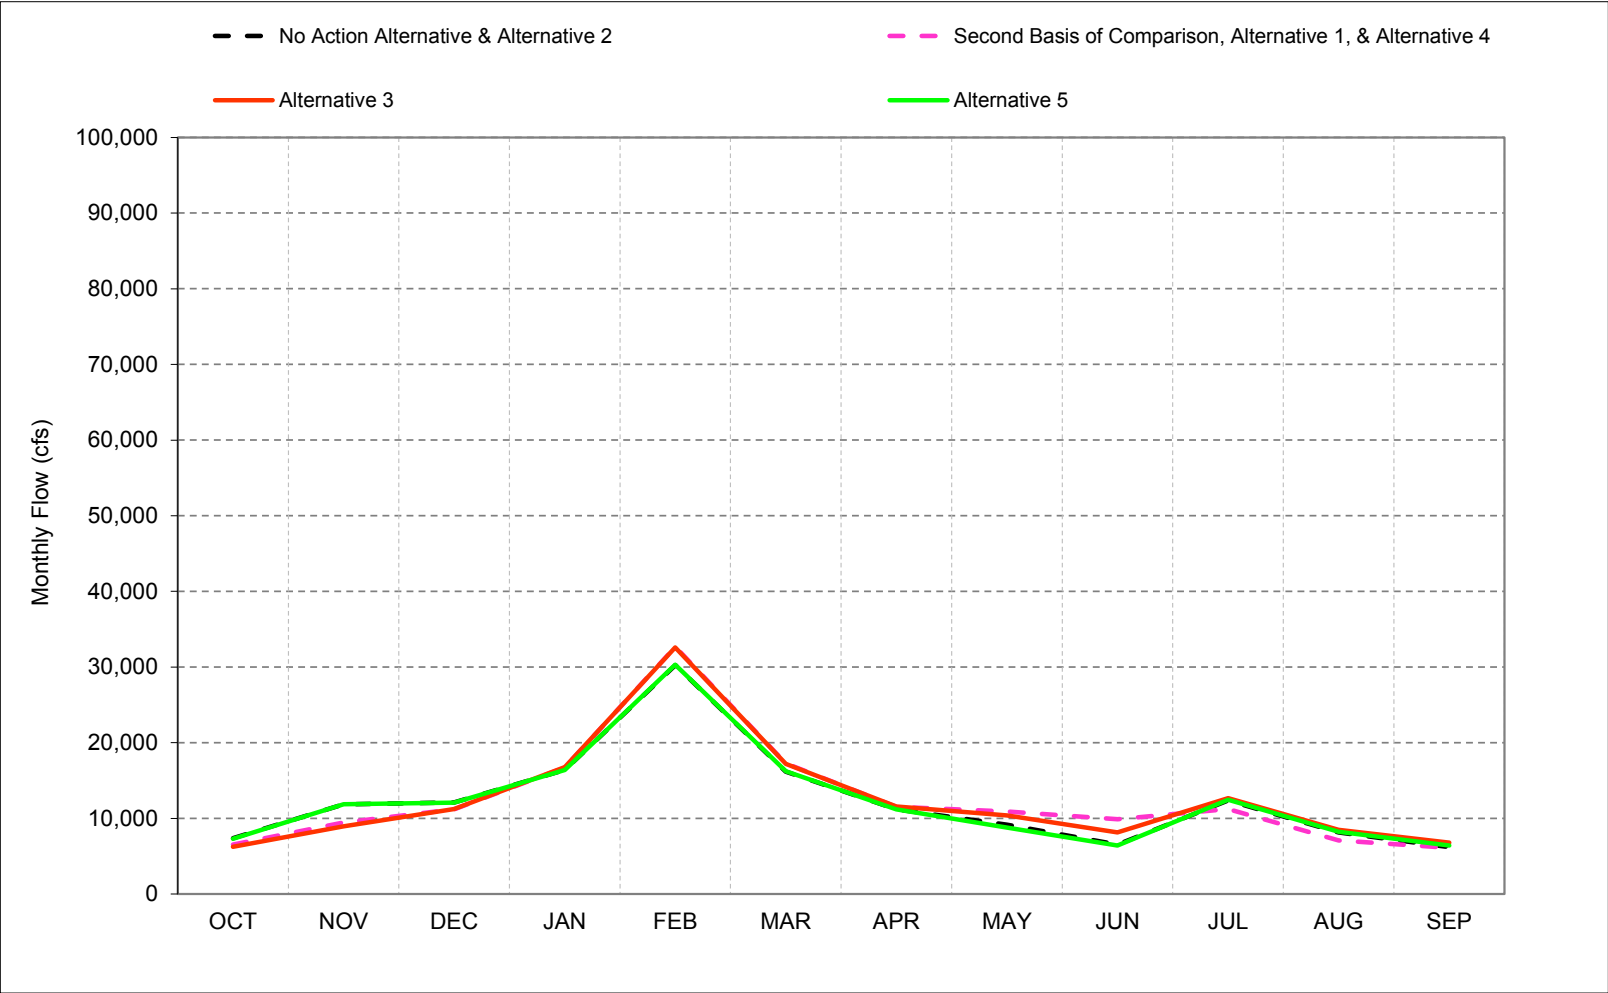


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-30-5. Sacramento River at Rio Vista, Dry Year* Long-Term** Average Flow

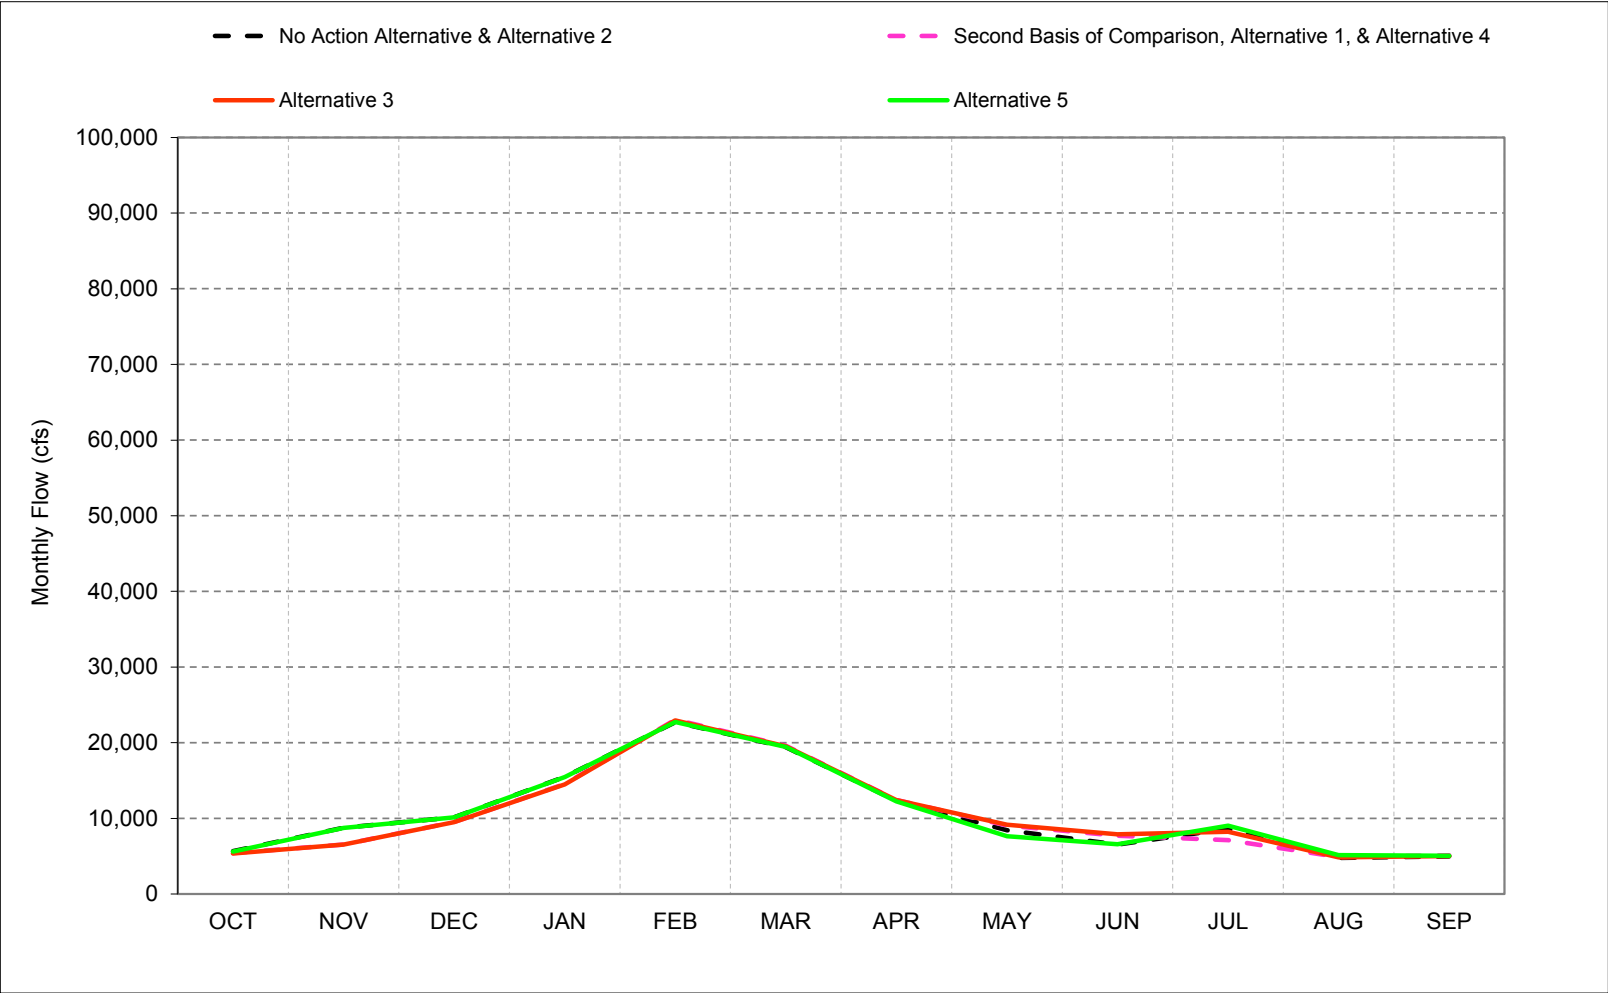


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-30-6. Sacramento River at Rio Vista, Critical Year* Long-Term** Average Flow

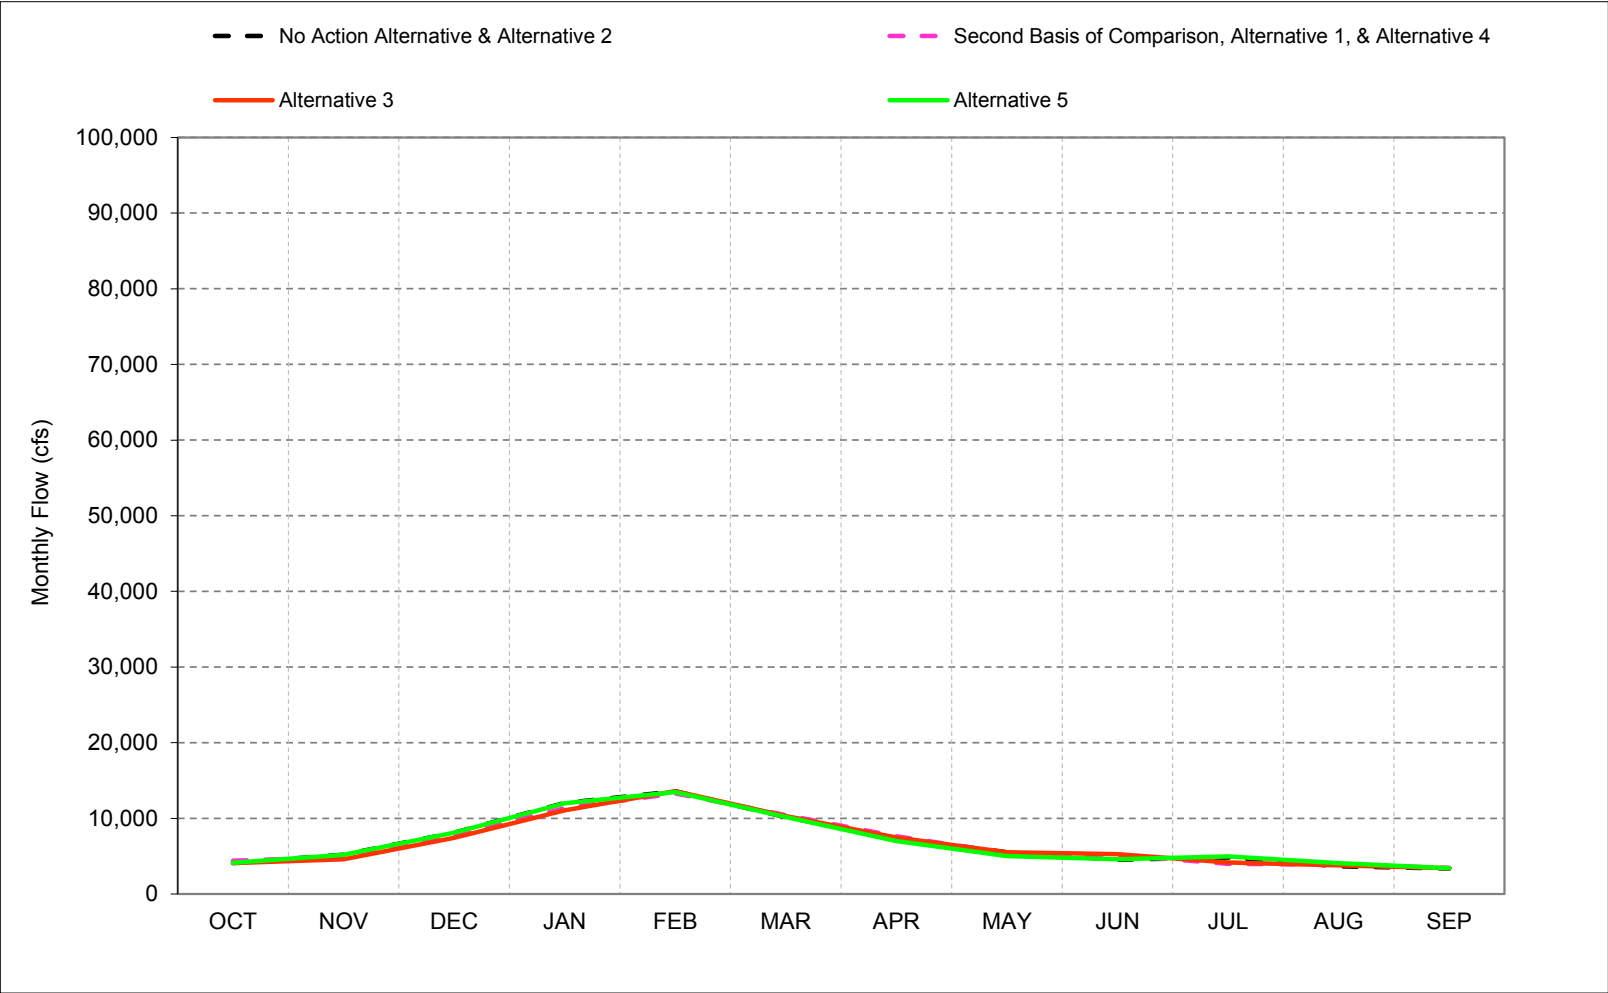

*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-30-1. Sacramento River at Rio Vista, Monthly Flow

No Action Alternative & Alternative 2												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	10,070	18,978	58,014	88,870	115,150	71,556	52,709	32,159	12,044	14,311	9,331	23,977
20%	9,164	15,087	33,016	59,223	73,063	55,386	33,858	21,120	9,112	13,769	9,021	23,320
30%	7,820	14,319	19,139	43,990	55,265	39,150	20,511	12,940	7,154	12,689	8,637	13,495
40%	6,837	12,410	15,044	26,918	43,815	28,806	17,119	9,913	6,800	11,527	8,237	12,638
50%	5,696	10,612	11,920	19,664	32,125	23,004	12,566	9,009	6,655	10,242	7,597	7,728
60%	4,657	8,444	10,519	15,734	23,143	17,885	9,773	8,093	6,402	9,294	7,198	6,444
70%	4,247	6,189	10,183	12,389	16,301	15,737	8,487	7,678	5,975	8,594	5,139	4,865
80%	3,935	4,800	6,794	10,428	13,181	11,784	7,768	7,067	5,215	7,289	4,202	3,999
90%	3,260	4,011	5,682	9,124	11,209	8,346	6,927	5,954	4,837	5,221	3,592	3,294
Long Term												
Full Simulation Period ^b	6,582	12,014	22,422	37,879	47,932	36,375	21,273	14,053	8,621	10,146	6,909	11,570
Water Year Types ^c												
Wet (32%)	8,546	16,954	42,039	73,996	85,996	65,510	38,081	24,838	13,700	11,352	8,425	22,213
Above Normal (16%)	5,650	13,536	23,981	42,104	57,259	45,401	22,762	13,104	7,166	13,089	9,057	12,475
Below Normal (13%)	7,377	11,863	12,133	16,417	30,256	16,204	11,190	9,160	6,541	12,354	8,153	6,213
Dry (24%)	5,672	8,760	10,143	15,485	22,720	19,433	12,329	8,452	6,559	8,641	4,784	5,005
Critical (15%)	4,120	5,220	8,128	12,048	13,576	10,197	7,390	5,535	4,537	4,827	3,696	3,381

Alternative 1												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	7,936	16,012	59,280	91,700	115,954	76,198	51,404	32,132	12,280	13,021	8,831	8,155
20%	7,592	9,452	34,803	60,639	73,800	55,589	33,804	22,340	11,036	12,187	8,574	7,770
30%	7,001	8,564	18,270	44,793	56,713	41,187	20,362	13,312	10,122	11,113	7,943	7,501
40%	6,038	8,016	13,391	26,341	49,187	29,860	17,124	11,207	9,247	10,377	7,536	7,315
50%	5,520	7,275	10,877	19,788	32,753	23,496	12,771	9,869	8,418	9,640	7,185	6,894
60%	5,002	6,617	9,412	14,739	23,353	18,189	9,629	9,369	7,891	8,661	5,815	6,014
70%	4,528	5,979	8,074	11,402	17,101	16,023	8,714	8,559	6,652	6,929	4,952	4,858
80%	4,107	5,091	6,604	9,443	13,382	12,111	8,104	7,695	6,268	5,965	4,428	4,138
90%	3,389	4,022	5,717	8,429	11,115	8,501	7,405	5,936	5,654	4,150	3,632	3,255
Long Term												
Full Simulation Period ^b	5,963	9,788	22,796	38,425	49,250	37,228	21,405	14,644	9,919	9,034	6,503	6,284
Water Year Types ^c												
Wet (32%)	7,239	14,226	45,019	76,053	87,371	66,392	38,027	25,019	14,188	10,354	7,761	7,961
Above Normal (16%)	5,193	10,653	22,550	43,221	60,499	47,632	23,011	14,132	9,164	12,139	8,384	7,447
Below Normal (13%)	6,564	9,456	11,190	16,732	32,676	17,278	11,534	10,910	9,888	11,233	7,092	6,118
Dry (24%)	5,418	6,568	9,526	14,565	23,057	19,592	12,439	9,069	7,718	7,116	4,894	5,129
Critical (15%)	4,392	4,907	7,671	11,351	13,313	10,450	7,643	5,432	5,181	3,991	3,883	3,465

Alternative 1 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-2,134	-2,966	1,266	2,830	804	4,642	-1,305	-28	236	-1,290	-500	-15,822
20%	-1,572	-5,635	1,788	1,416	737	203	-54	1,221	1,924	-1,583	-447	-15,550
30%	-819	-5,755	-869	803	1,448	2,037	-149	372	2,968	-1,576	-694	-5,994
40%	-799	-4,394	-1,653	-577	5,372	1,054	4	1,295	2,446	-1,150	-701	-5,323
50%	-176	-3,337	-1,043	124	628	492	205	859	1,763	-602	-412	-834
60%	344	-1,827	-1,107	-995	210	304	-144	1,276	1,489	-633	-1,383	-430
70%	281	-210	-2,109	-986	801	286	228	881	677	-1,665	-186	-7
80%	172	291	-191	-985	201	327	336	628	1,054	-1,324	227	139
90%	129	12	35	-696	-93	155	477	-19	817	-1,070	40	-39
Long Term												
Full Simulation Period ^b	-618	-2,226	374	545	1,318	853	133	591	1,297	-1,111	-406	-5,286
Water Year Types ^c												
Wet (32%)	-1,308	-2,728	2,980	2,056	1,376	882	-54	181	488	-998	-664	-14,251
Above Normal (16%)	-458	-2,884	-1,431	1,118	3,240	2,231	249	1,027	1,998	-950	-673	-5,029
Below Normal (13%)	-813	-2,407	-943	315	2,420	1,075	344	1,750	3,347	-1,121	-1,062	-94
Dry (24%)	-254	-2,193	-617	-919	337	158	111	617	1,159	-1,524	110	124
Critical (15%)	272	-313	-457	-698	-263	252	253	-102	645	-836	187	84

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c AS defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-30-2. Sacramento River at Rio Vista, Monthly Flow

No Action Alternative & Alternative 2

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	10,070	18,978	58,014	88,870	115,150	71,556	52,709	32,159	12,044	14,311	9,331	23,977
20%	9,164	15,087	33,016	59,223	73,063	55,386	33,858	21,120	9,112	13,769	9,021	23,320
30%	7,820	14,319	19,139	43,990	55,265	39,150	20,511	12,940	7,154	12,689	8,637	13,495
40%	6,837	12,410	15,044	26,918	43,815	28,806	17,119	9,913	6,800	11,527	8,237	12,638
50%	5,696	10,612	11,920	19,664	32,125	23,004	12,566	9,009	6,655	10,242	7,597	7,728
60%	4,657	8,444	10,519	15,734	23,143	17,885	9,773	8,093	6,402	9,294	7,198	6,444
70%	4,247	6,189	10,183	12,389	16,301	15,737	8,487	7,678	5,975	8,594	5,139	4,865
80%	3,935	4,800	6,794	10,428	13,181	11,784	7,768	7,067	5,215	7,289	4,202	3,999
90%	3,260	4,011	5,682	9,124	11,209	8,346	6,927	5,954	4,837	5,221	3,592	3,294
Long Term												
Full Simulation Period ^b	6,582	12,014	22,422	37,879	47,932	36,375	21,273	14,053	8,621	10,146	6,909	11,570
Water Year Types ^c												
Wet (32%)	8,546	16,954	42,039	73,996	85,996	65,510	38,081	24,838	13,700	11,352	8,425	22,213
Above Normal (16%)	5,650	13,536	23,981	42,104	57,259	45,401	22,762	13,104	7,166	13,089	9,057	12,475
Below Normal (13%)	7,377	11,863	12,133	16,417	30,256	16,204	11,190	9,160	6,541	12,354	8,153	6,213
Dry (24%)	5,672	8,760	10,143	15,485	22,720	19,433	12,329	8,452	6,559	8,641	4,784	5,005
Critical (15%)	4,120	5,220	8,128	12,048	13,576	10,197	7,390	5,535	4,537	4,827	3,696	3,381

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	7,954	16,006	60,411	91,548	115,759	74,068	51,953	32,121	11,790	13,871	9,089	8,186
20%	7,349	9,732	35,930	60,659	74,471	55,585	33,797	21,564	10,764	13,398	8,857	7,898
30%	6,676	8,627	18,042	44,626	56,689	40,207	20,482	13,162	9,187	13,034	8,204	7,468
40%	6,159	7,822	13,466	26,035	49,055	29,853	17,049	11,324	8,737	11,626	7,879	7,156
50%	5,457	7,283	10,961	19,032	32,637	23,522	12,775	9,807	8,372	10,267	7,266	6,934
60%	4,540	6,524	9,468	14,903	23,481	18,149	9,676	8,808	7,718	9,308	6,754	6,239
70%	4,137	6,021	8,437	11,280	17,194	16,114	8,836	8,317	7,279	7,631	5,433	4,830
80%	3,947	4,912	6,649	9,425	13,173	12,063	8,010	7,821	6,326	6,527	4,278	4,140
90%	3,255	4,020	5,536	8,233	11,220	8,370	7,342	6,223	5,519	4,434	3,543	3,164
Long Term												
Full Simulation Period ^b	5,814	9,693	22,698	38,205	49,065	37,021	21,373	14,632	9,809	9,824	6,741	6,305
Water Year Types ^c												
Wet (32%)	7,114	14,209	44,782	75,904	87,147	66,076	38,034	25,087	14,587	10,942	7,814	7,836
Above Normal (16%)	5,095	10,808	22,598	42,408	59,743	47,228	22,970	14,131	8,754	12,872	8,695	7,468
Below Normal (13%)	6,235	8,981	11,261	16,777	32,582	17,195	11,575	10,388	8,166	12,666	8,512	6,807
Dry (24%)	5,377	6,530	9,495	14,518	22,947	19,552	12,408	9,167	7,914	8,224	4,861	5,010
Critical (15%)	4,118	4,626	7,447	11,093	13,627	10,298	7,468	5,518	5,265	4,164	3,812	3,424

Alternative 3 minus No Action Alternative & Alternative 2

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-2,116	-2,971	2,397	2,677	609	2,512	-756	-39	-254	-440	-242	-15,791
20%	-1,814	-5,355	2,914	1,436	1,408	199	-61	445	1,652	-371	-163	-15,422
30%	-1,144	-5,693	-1,097	637	1,423	1,057	-29	222	2,033	345	-433	-6,027
40%	-678	-4,588	-1,578	-883	5,240	1,047	-71	1,411	1,937	98	-358	-5,482
50%	-238	-3,329	-959	-632	512	518	209	798	1,717	25	-331	-794
60%	-117	-1,920	-1,051	-831	338	264	-97	715	1,316	15	-443	-204
70%	-110	-168	-1,746	-1,108	893	377	349	639	1,304	-963	294	-35
80%	11	112	-145	-1,002	-8	279	242	754	1,111	-762	76	141
90%	-6	10	-145	-891	11	24	414	268	681	-786	-49	-130
Long Term												
Full Simulation Period ^b	-768	-2,321	276	326	1,134	646	101	579	1,188	-321	-167	-5,265
Water Year Types ^c												
Wet (32%)	-1,433	-2,745	2,743	1,908	1,151	566	-47	249	887	-410	-611	-14,377
Above Normal (16%)	-555	-2,728	-1,383	304	2,485	1,827	209	1,027	1,588	-217	-362	-5,007
Below Normal (13%)	-1,142	-2,881	-872	359	2,326	992	385	1,228	1,625	312	359	594
Dry (24%)	-295	-2,230	-648	-966	227	118	80	715	1,355	-417	77	5
Critical (15%)	-2	-594	-681	-956	50	101	79	-17	728	-663	116	42

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c AS defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-30-3. Sacramento River at Rio Vista, Monthly Flow

No Action Alternative & Alternative 2

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	10,070	18,978	58,014	88,870	115,150	71,556	52,709	32,159	12,044	14,311	9,331	23,977
20%	9,164	15,087	33,016	59,223	73,063	55,386	33,858	21,120	9,112	13,769	9,021	23,320
30%	7,820	14,319	19,139	43,990	55,265	39,150	20,511	12,940	7,154	12,689	8,637	13,495
40%	6,837	12,410	15,044	26,918	43,815	28,806	17,119	9,913	6,800	11,527	8,237	12,638
50%	5,696	10,612	11,920	19,664	32,125	23,004	12,566	9,009	6,655	10,242	7,597	7,728
60%	4,657	8,444	10,519	15,734	23,143	17,885	9,773	8,093	6,402	9,294	7,198	6,444
70%	4,247	6,189	10,183	12,389	16,301	15,737	8,487	7,678	5,975	8,594	5,139	4,865
80%	3,935	4,800	6,794	10,428	13,181	11,784	7,768	7,067	5,215	7,289	4,202	3,999
90%	3,260	4,011	5,682	9,124	11,209	8,346	6,927	5,954	4,837	5,221	3,592	3,294
Long Term												
Full Simulation Period ^b	6,582	12,014	22,422	37,879	47,932	36,375	21,273	14,053	8,621	10,146	6,909	11,570
Water Year Types ^c												
Wet (32%)	8,546	16,954	42,039	73,996	85,996	65,510	38,081	24,838	13,700	11,352	8,425	22,213
Above Normal (16%)	5,650	13,536	23,981	42,104	57,259	45,401	22,762	13,104	7,166	13,089	9,057	12,475
Below Normal (13%)	7,377	11,863	12,133	16,417	30,256	16,204	11,190	9,160	6,541	12,354	8,153	6,213
Dry (24%)	5,672	8,760	10,143	15,485	22,720	19,433	12,329	8,452	6,559	8,641	4,784	5,005
Critical (15%)	4,120	5,220	8,128	12,048	13,576	10,197	7,390	5,535	4,537	4,827	3,696	3,381

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	10,094	18,906	58,192	87,361	115,151	71,563	52,709	32,164	12,098	14,214	9,400	23,931
20%	8,702	15,066	33,012	59,113	73,118	55,358	33,862	21,077	9,063	13,803	9,066	23,141
30%	7,616	14,401	19,148	43,992	55,699	39,157	20,576	12,945	7,163	13,152	8,660	13,501
40%	6,915	12,559	15,050	26,809	43,815	28,822	17,139	9,532	6,803	11,639	8,257	12,562
50%	5,973	10,603	11,923	19,684	32,387	22,896	12,582	8,592	6,633	10,511	7,890	7,921
60%	4,624	8,466	10,503	15,733	23,141	17,883	9,449	7,823	6,441	9,531	7,392	6,668
70%	4,312	6,202	10,097	12,390	16,303	15,706	8,668	6,906	5,981	9,114	5,457	4,960
80%	3,990	4,799	6,804	10,462	13,181	11,781	7,452	6,414	5,162	7,510	4,448	4,211
90%	3,291	4,017	5,656	9,117	11,173	8,346	6,712	5,188	4,806	5,427	3,831	3,370
Long Term												
Full Simulation Period ^b	6,555	12,049	22,404	37,806	47,909	36,373	21,208	13,710	8,608	10,348	7,081	11,562
Water Year Types ^c												
Wet (32%)	8,465	17,099	41,993	73,808	85,986	65,543	38,083	24,834	13,674	11,515	8,488	22,059
Above Normal (16%)	5,746	13,499	24,025	42,096	57,115	45,328	22,768	12,943	7,133	13,127	9,015	12,411
Below Normal (13%)	7,311	11,858	12,095	16,389	30,330	16,221	11,220	8,790	6,427	12,485	8,257	6,438
Dry (24%)	5,628	8,744	10,132	15,472	22,747	19,433	12,263	7,651	6,588	9,060	5,144	5,080
Critical (15%)	4,145	5,217	8,105	12,011	13,488	10,178	7,021	5,047	4,594	4,996	4,087	3,400

Alternative 5 minus No Action Alternative & Alternative 2

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	24	-72	178	-1,510	1	7	0	5	54	-96	68	-46
20%	-461	-21	-4	-110	55	-28	4	-43	-49	34	45	-179
30%	-204	82	8	2	434	7	65	4	9	463	23	6
40%	77	149	6	-110	0	15	20	-380	2	112	20	-76
50%	278	-9	3	20	261	-108	16	-417	-23	269	293	193
60%	-33	22	-16	-1	-2	-2	-324	-270	38	237	194	224
70%	65	13	-86	2	2	-31	182	-772	6	520	319	95
80%	54	0	10	34	-1	-3	-315	-653	-52	222	246	212
90%	31	6	-26	-8	-36	0	-216	-767	-31	207	239	76
Long Term												
Full Simulation Period ^b	-27	35	-19	-73	-22	-2	-64	-343	-13	202	172	-7
Water Year Types ^c												
Wet (32%)	-81	145	-46	-188	-9	33	1	-4	-26	163	63	-153
Above Normal (16%)	96	-37	44	-7	-144	-74	6	-161	-33	39	-42	-64
Below Normal (13%)	-67	-5	-38	-28	74	17	31	-370	-114	131	104	226
Dry (24%)	-44	-16	-11	-13	27	0	-65	-801	30	419	360	75
Critical (15%)	26	-3	-23	-37	-88	-19	-369	-488	57	168	391	19

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-30-4. Sacramento River at Rio Vista, Monthly Flow

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance^a												
10%	7,936	16,012	59,280	91,700	115,954	76,198	51,404	32,132	12,280	13,021	8,831	8,155
20%	7,592	9,452	34,803	60,639	73,800	55,589	33,804	22,340	11,036	12,187	8,574	7,770
30%	7,001	8,564	18,270	44,793	56,713	41,187	20,362	13,312	10,122	11,113	7,943	7,501
40%	6,038	8,016	13,391	26,341	49,187	29,860	17,124	11,207	9,247	10,377	7,536	7,315
50%	5,520	7,275	10,877	19,788	32,753	23,496	12,771	9,869	8,418	9,640	7,185	6,894
60%	5,002	6,617	9,412	14,739	23,353	18,189	9,629	9,369	7,891	8,661	5,815	6,014
70%	4,528	5,979	8,074	11,402	17,101	16,023	8,714	8,559	6,652	6,929	4,952	4,858
80%	4,107	5,091	6,604	9,443	13,382	12,111	8,104	7,695	6,268	5,965	4,428	4,138
90%	3,389	4,022	5,717	8,429	11,115	8,501	7,405	5,936	5,654	4,150	3,632	3,255
Long Term												
Full Simulation Period ^b	5,963	9,788	22,796	38,425	49,250	37,228	21,405	14,644	9,919	9,034	6,503	6,284
Water Year Types^c												
Wet (32%)	7,239	14,226	45,019	76,053	87,371	66,392	38,027	25,019	14,188	10,354	7,761	7,961
Above Normal (16%)	5,193	10,653	22,550	43,221	60,499	47,632	23,011	14,132	9,164	12,139	8,384	7,447
Below Normal (13%)	6,564	9,456	11,190	16,732	32,676	17,278	11,534	10,910	9,888	11,233	7,092	6,118
Dry (24%)	5,418	6,568	9,526	14,565	23,057	19,592	12,439	9,069	7,718	7,116	4,894	5,129
Critical (15%)	4,392	4,907	7,671	11,351	13,313	10,450	7,643	5,432	5,181	3,991	3,883	3,465

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative & Alternative 2												
Probability of Exceedance^a												
10%	10,070	18,978	58,014	88,870	115,150	71,556	52,709	32,159	12,044	14,311	9,331	23,977
20%	9,164	15,087	33,016	59,223	73,063	55,386	33,858	21,120	9,112	13,769	9,021	23,320
30%	7,820	14,319	19,139	43,990	55,265	39,150	20,511	12,940	7,154	12,689	8,637	13,495
40%	6,837	12,410	15,044	26,918	43,815	28,806	17,119	9,913	6,800	11,527	8,237	12,638
50%	5,696	10,612	11,920	19,664	32,125	23,004	12,566	9,009	6,655	10,242	7,597	7,728
60%	4,657	8,444	10,519	15,734	23,143	17,885	9,773	8,093	6,402	9,294	7,198	6,444
70%	4,247	6,189	10,183	12,389	16,301	15,737	8,487	7,678	5,975	8,594	5,139	4,865
80%	3,935	4,800	6,794	10,428	13,181	11,784	7,768	7,067	5,215	7,289	4,202	3,999
90%	3,260	4,011	5,682	9,124	11,209	8,346	6,927	5,954	4,837	5,221	3,592	3,294
Long Term												
Full Simulation Period ^b	6,582	12,014	22,422	37,879	47,932	36,375	21,273	14,053	8,621	10,146	6,909	11,570
Water Year Types^c												
Wet (32%)	8,546	16,954	42,039	73,996	85,996	65,510	38,081	24,838	13,700	11,352	8,425	22,213
Above Normal (16%)	5,650	13,536	23,981	42,104	57,259	45,401	22,762	13,104	7,166	13,089	9,057	12,475
Below Normal (13%)	7,377	11,863	12,133	16,417	30,256	16,204	11,190	9,160	6,541	12,354	8,153	6,213
Dry (24%)	5,672	8,760	10,143	15,485	22,720	19,433	12,329	8,452	6,559	8,641	4,784	5,005
Critical (15%)	4,120	5,220	8,128	12,048	13,576	10,197	7,390	5,535	4,537	4,827	3,696	3,381

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative & Alternative 2 minus Second Basis of Comparison												
Probability of Exceedance^a												
10%	2,134	2,966	-1,266	-2,830	-804	-4,642	1,305	28	-236	1,290	500	15,822
20%	1,572	5,635	-1,788	-1,416	-737	-203	54	-1,221	-1,924	1,583	447	15,550
30%	819	5,755	869	-803	-1,448	-2,037	149	-372	-2,968	1,576	694	5,994
40%	799	4,394	1,653	577	-5,372	-1,054	-4	-1,295	-2,446	1,150	701	5,323
50%	176	3,337	1,043	-124	-628	-492	-205	-859	-1,763	602	412	834
60%	-344	1,827	1,107	995	-210	-304	144	-1,276	-1,489	633	1,383	430
70%	-281	210	2,109	986	-801	-286	-228	-881	-677	1,665	186	7
80%	-172	-291	191	985	-201	-327	-336	-628	-1,054	1,324	-227	-139
90%	-129	-12	-35	696	93	-155	-477	19	-817	1,070	-40	39
Long Term												
Full Simulation Period ^b	618	2,226	-374	-545	-1,318	-853	-133	-591	-1,297	1,111	406	5,286
Water Year Types^c												
Wet (32%)	1,308	2,728	-2,980	-2,056	-1,376	-882	54	-181	-488	998	664	14,251
Above Normal (16%)	458	2,884	1,431	-1,118	-3,240	-2,231	-249	-1,027	-1,998	950	673	5,029
Below Normal (13%)	813	2,407	943	-315	-2,420	-1,075	-344	-1,750	-3,347	1,121	1,062	94
Dry (24%)	254	2,193	617	919	-337	-158	-111	-617	-1,159	1,524	-110	-124
Critical (15%)	-272	313	457	698	263	-252	-253	102	-645	836	-187	-84

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
b Based on the 82-year simulation period.
c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-30-5. Sacramento River at Rio Vista, Monthly Flow

Second Basis of Comparison												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	7,936	16,012	59,280	91,700	115,954	76,198	51,404	32,132	12,280	13,021	8,831	8,155
20%	7,592	9,452	34,803	60,639	73,800	55,589	33,804	22,340	11,036	12,187	8,574	7,770
30%	7,001	8,564	18,270	44,793	56,713	41,187	20,362	13,312	10,122	11,113	7,943	7,501
40%	6,038	8,016	13,391	26,341	49,187	29,860	17,124	11,207	9,247	10,377	7,536	7,315
50%	5,520	7,275	10,877	19,788	32,753	23,496	12,771	9,869	8,418	9,640	7,185	6,894
60%	5,002	6,617	9,412	14,739	23,353	18,189	9,629	9,369	7,891	8,661	5,815	6,014
70%	4,528	5,979	8,074	11,402	17,101	16,023	8,714	8,559	6,652	6,929	4,952	4,858
80%	4,107	5,091	6,604	9,443	13,382	12,111	8,104	7,695	6,268	5,965	4,428	4,138
90%	3,389	4,022	5,717	8,429	11,115	8,501	7,405	5,936	5,654	4,150	3,632	3,255
Long Term												
Full Simulation Period ^b	5,963	9,788	22,796	38,425	49,250	37,228	21,405	14,644	9,919	9,034	6,503	6,284
Water Year Types^c												
Wet (32%)	7,239	14,226	45,019	76,053	87,371	66,392	38,027	25,019	14,188	10,354	7,761	7,961
Above Normal (16%)	5,193	10,653	22,550	43,221	60,499	47,632	23,011	14,132	9,164	12,139	8,384	7,447
Below Normal (13%)	6,564	9,456	11,190	16,732	32,676	17,278	11,534	10,910	9,888	11,233	7,092	6,118
Dry (24%)	5,418	6,568	9,526	14,565	23,057	19,592	12,439	9,069	7,718	7,116	4,894	5,129
Critical (15%)	4,392	4,907	7,671	11,351	13,313	10,450	7,643	5,432	5,181	3,991	3,883	3,465

Alternative 3												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	7,954	16,006	60,411	91,548	115,759	74,068	51,953	32,121	11,790	13,871	9,089	8,186
20%	7,349	9,732	35,930	60,659	74,471	55,585	33,797	21,564	10,764	13,398	8,857	7,898
30%	6,676	8,627	18,042	44,626	56,689	40,207	20,482	13,162	9,187	13,034	8,204	7,468
40%	6,159	7,822	13,466	26,035	49,055	29,853	17,049	11,324	8,737	11,626	7,879	7,156
50%	5,457	7,283	10,961	19,032	32,637	23,522	12,775	9,807	8,372	10,267	7,266	6,934
60%	4,540	6,524	9,468	14,903	23,481	18,149	9,676	8,808	7,718	9,308	6,754	6,239
70%	4,137	6,021	8,437	11,280	17,194	16,114	8,836	8,317	7,279	7,631	5,433	4,830
80%	3,947	4,912	6,649	9,425	13,173	12,063	8,010	7,821	6,326	6,527	4,278	4,140
90%	3,255	4,020	5,536	8,233	11,220	8,370	7,342	6,223	5,519	4,434	3,543	3,164
Long Term												
Full Simulation Period ^b	5,814	9,693	22,698	38,205	49,065	37,021	21,373	14,632	9,809	9,824	6,741	6,305
Water Year Types^c												
Wet (32%)	7,114	14,209	44,782	75,904	87,147	66,076	38,034	25,087	14,587	10,942	7,814	7,836
Above Normal (16%)	5,095	10,808	22,598	42,408	59,743	47,228	22,970	14,131	8,754	12,872	8,695	7,468
Below Normal (13%)	6,235	8,981	11,261	16,777	32,582	17,195	11,575	10,388	8,166	12,666	8,512	6,807
Dry (24%)	5,377	6,530	9,495	14,518	22,947	19,552	12,408	9,167	7,914	8,224	4,861	5,010
Critical (15%)	4,118	4,626	7,447	11,093	13,627	10,298	7,468	5,518	5,265	4,164	3,812	3,424

Alternative 3 minus Second Basis of Comparison												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	18	-6	1,131	-153	-195	-2,130	549	-11	-490	850	258	31
20%	-243	280	1,126	20	671	-4	-7	-776	-272	1,211	284	128
30%	-325	62	-228	-166	-24	-980	120	-150	-935	1,921	260	-33
40%	121	-195	75	-306	-132	-8	-75	116	-510	1,248	343	-159
50%	-62	8	83	-756	-116	25	4	-61	-46	627	82	40
60%	-461	-93	56	164	127	-40	47	-561	-173	647	939	225
70%	-391	42	363	-122	92	91	121	-241	627	702	481	-28
80%	-160	-179	46	-17	-209	-48	-93	126	57	562	-150	2
90%	-134	-2	-180	-195	104	-132	-63	287	-136	284	-89	-91
Long Term												
Full Simulation Period ^b	-149	-95	-98	-219	-184	-207	-32	-12	-110	790	238	21
Water Year Types^c												
Wet (32%)	-125	-17	-237	-148	-224	-316	7	68	399	588	53	-125
Above Normal (16%)	-98	156	48	-814	-755	-404	-40	0	-410	733	311	22
Below Normal (13%)	-329	-474	72	45	-93	-83	41	-522	-1,722	1,433	1,421	689
Dry (24%)	-41	-38	-31	-47	-110	-40	-31	98	196	1,107	-33	-119
Critical (15%)	-274	-282	-224	-258	314	-152	-174	85	83	173	-71	-42

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
^b Based on the 82-year simulation period.
^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-30-6. Sacramento River at Rio Vista, Monthly Flow

Second Basis of Comparison		Monthly Flow (cfs)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
10%	7,936	16,012	59,280	91,700	115,954	76,198	51,404	32,132	12,280	13,021	8,831	8,155	
20%	7,592	9,452	34,803	60,639	73,800	55,589	33,804	22,340	11,036	12,187	8,574	7,770	
30%	7,001	8,564	18,270	44,793	56,713	41,187	20,362	13,312	10,122	11,113	7,943	7,501	
40%	6,038	8,016	13,391	26,341	49,187	29,860	17,124	11,207	9,247	10,377	7,536	7,315	
50%	5,520	7,275	10,877	19,788	32,753	23,496	12,771	9,869	8,418	9,640	7,185	6,894	
60%	5,002	6,617	9,412	14,739	23,353	18,189	9,629	9,369	7,891	8,661	5,815	6,014	
70%	4,528	5,979	8,074	11,402	17,101	16,023	8,714	8,559	6,652	6,929	4,952	4,858	
80%	4,107	5,091	6,604	9,443	13,382	12,111	8,104	7,695	6,268	5,965	4,428	4,138	
90%	3,389	4,022	5,717	8,429	11,115	8,501	7,405	5,936	5,654	4,150	3,632	3,255	
Long Term													
Full Simulation Period ^b	5,963	9,788	22,796	38,425	49,250	37,228	21,405	14,644	9,919	9,034	6,503	6,284	
Water Year Types ^c													
Wet (32%)	7,239	14,226	45,019	76,053	87,371	66,392	38,027	25,019	14,188	10,354	7,761	7,961	
Above Normal (16%)	5,193	10,653	22,550	43,221	60,499	47,632	23,011	14,132	9,164	12,139	8,384	7,447	
Below Normal (13%)	6,564	9,456	11,190	16,732	32,676	17,278	11,534	10,910	9,888	11,233	7,092	6,118	
Dry (24%)	5,418	6,568	9,526	14,565	23,057	19,592	12,439	9,069	7,718	7,116	4,894	5,129	
Critical (15%)	4,392	4,907	7,671	11,351	13,313	10,450	7,643	5,432	5,181	3,991	3,883	3,465	

Alternative 5		Monthly Flow (cfs)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
10%	10,094	18,906	58,192	87,361	115,151	71,563	52,709	32,164	12,098	14,214	9,400	23,931	
20%	8,702	15,066	33,012	59,113	73,118	55,358	33,862	21,077	9,063	13,803	9,066	23,141	
30%	7,616	14,401	19,148	43,992	55,699	39,157	20,576	12,945	7,163	13,152	8,660	13,501	
40%	6,915	12,559	15,050	26,809	43,815	28,822	17,139	9,532	6,803	11,639	8,257	12,562	
50%	5,973	10,603	11,923	19,684	32,387	22,896	12,582	8,592	6,633	10,511	7,890	7,921	
60%	4,624	8,466	10,503	15,733	23,141	17,883	9,449	7,823	6,441	9,531	7,392	6,668	
70%	4,312	6,202	10,097	12,390	16,303	15,706	8,668	6,906	5,981	9,114	5,457	4,960	
80%	3,990	4,799	6,804	10,462	13,181	11,781	7,452	6,414	5,162	7,510	4,448	4,211	
90%	3,291	4,017	5,656	9,117	11,173	8,346	6,712	5,188	4,806	5,427	3,831	3,370	
Long Term													
Full Simulation Period ^b	6,555	12,049	22,404	37,806	47,909	36,373	21,208	13,710	8,608	10,348	7,081	11,562	
Water Year Types ^c													
Wet (32%)	8,465	17,099	41,993	73,808	85,986	65,543	38,083	24,834	13,674	11,515	8,488	22,059	
Above Normal (16%)	5,746	13,499	24,025	42,096	57,115	45,328	22,768	12,943	7,133	13,127	9,015	12,411	
Below Normal (13%)	7,311	11,858	12,095	16,389	30,330	16,221	11,220	8,790	6,427	12,485	8,257	6,438	
Dry (24%)	5,628	8,744	10,132	15,472	22,747	19,433	12,263	7,651	6,588	9,060	5,144	5,080	
Critical (15%)	4,145	5,217	8,105	12,011	13,488	10,178	7,021	5,047	4,594	4,996	4,087	3,400	


Alternative 5 minus Second Basis of Comparison		Monthly Flow (cfs)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
10%	2,157	2,894	-1,088	-4,340	-803	-4,635	1,305	33	-182	1,193	569	15,776	
20%	1,110	5,615	-1,791	-1,527	-682	-231	58	-1,263	-1,973	1,617	492	15,371	
30%	615	5,837	877	-801	-1,014	-2,030	214	-367	-2,959	2,039	717	5,999	
40%	876	4,542	1,659	468	-5,372	-1,039	16	-1,675	-2,444	1,262	720	5,247	
50%	453	3,328	1,046	-104	-366	-601	-190	-1,277	-1,785	871	705	1,027	
60%	-378	1,849	1,091	994	-212	-305	-180	-1,546	-1,450	870	1,577	654	
70%	-216	223	2,023	988	-799	-316	-46	-1,652	-671	2,185	505	102	
80%	-118	-292	201	1,019	-202	-330	-651	-1,281	-1,106	1,546	19	73	
90%	-98	-5	-61	688	58	-155	-693	-748	-848	1,277	199	115	
Long Term													
Full Simulation Period ^b	592	2,261	-393	-618	-1,340	-855	-197	-934	-1,311	1,314	578	5,279	
Water Year Types ^c													
Wet (32%)	1,226	2,873	-3,026	-2,245	-1,385	-849	55	-185	-514	1,160	727	14,098	
Above Normal (16%)	553	2,847	1,475	-1,125	-3,384	-2,305	-243	-1,189	-2,030	989	631	4,965	
Below Normal (13%)	747	2,402	906	-343	-2,345	-1,057	-314	-2,120	-3,461	1,252	1,166	320	
Dry (24%)	210	2,176	606	906	-310	-158	-176	-1,419	-1,130	1,944	250	-49	
Critical (15%)	-247	310	434	660	175	-271	-621	-386	-588	1,004	204	-65	

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c AS defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1 **C.31. Delta Cross Channel Flow**


Figure C-31-1. Delta Cross Channel, Long-Term* Average Flow

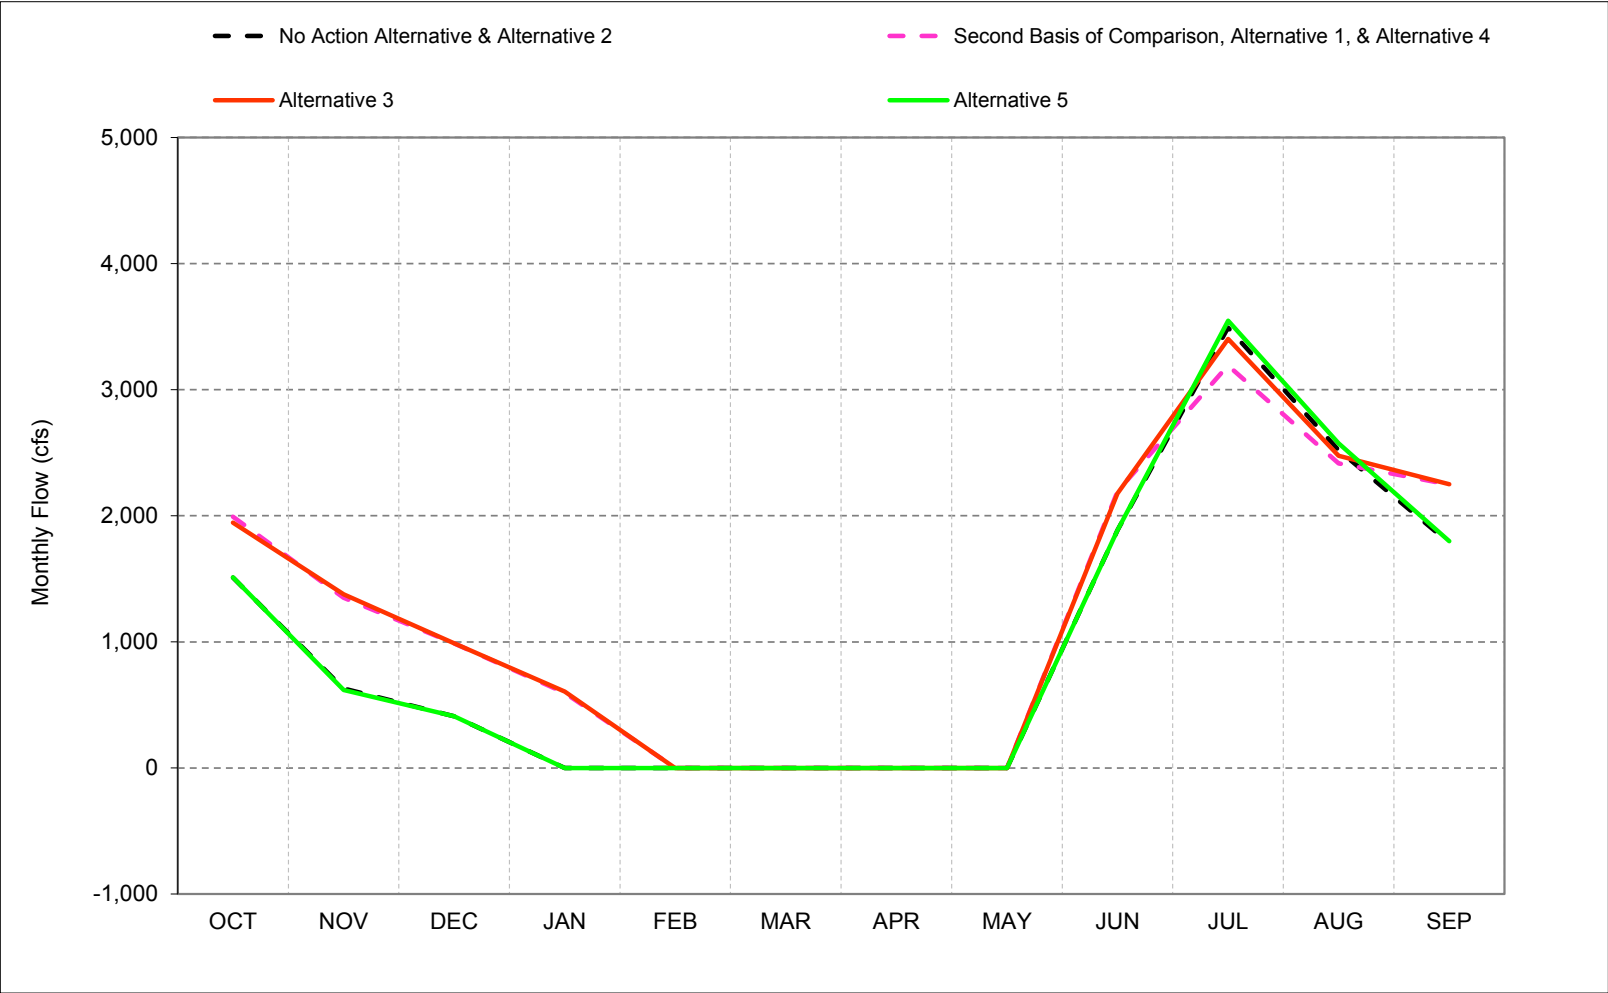

*Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-31-2. Delta Cross Channel, Wet Year* Long-Term** Average Flow

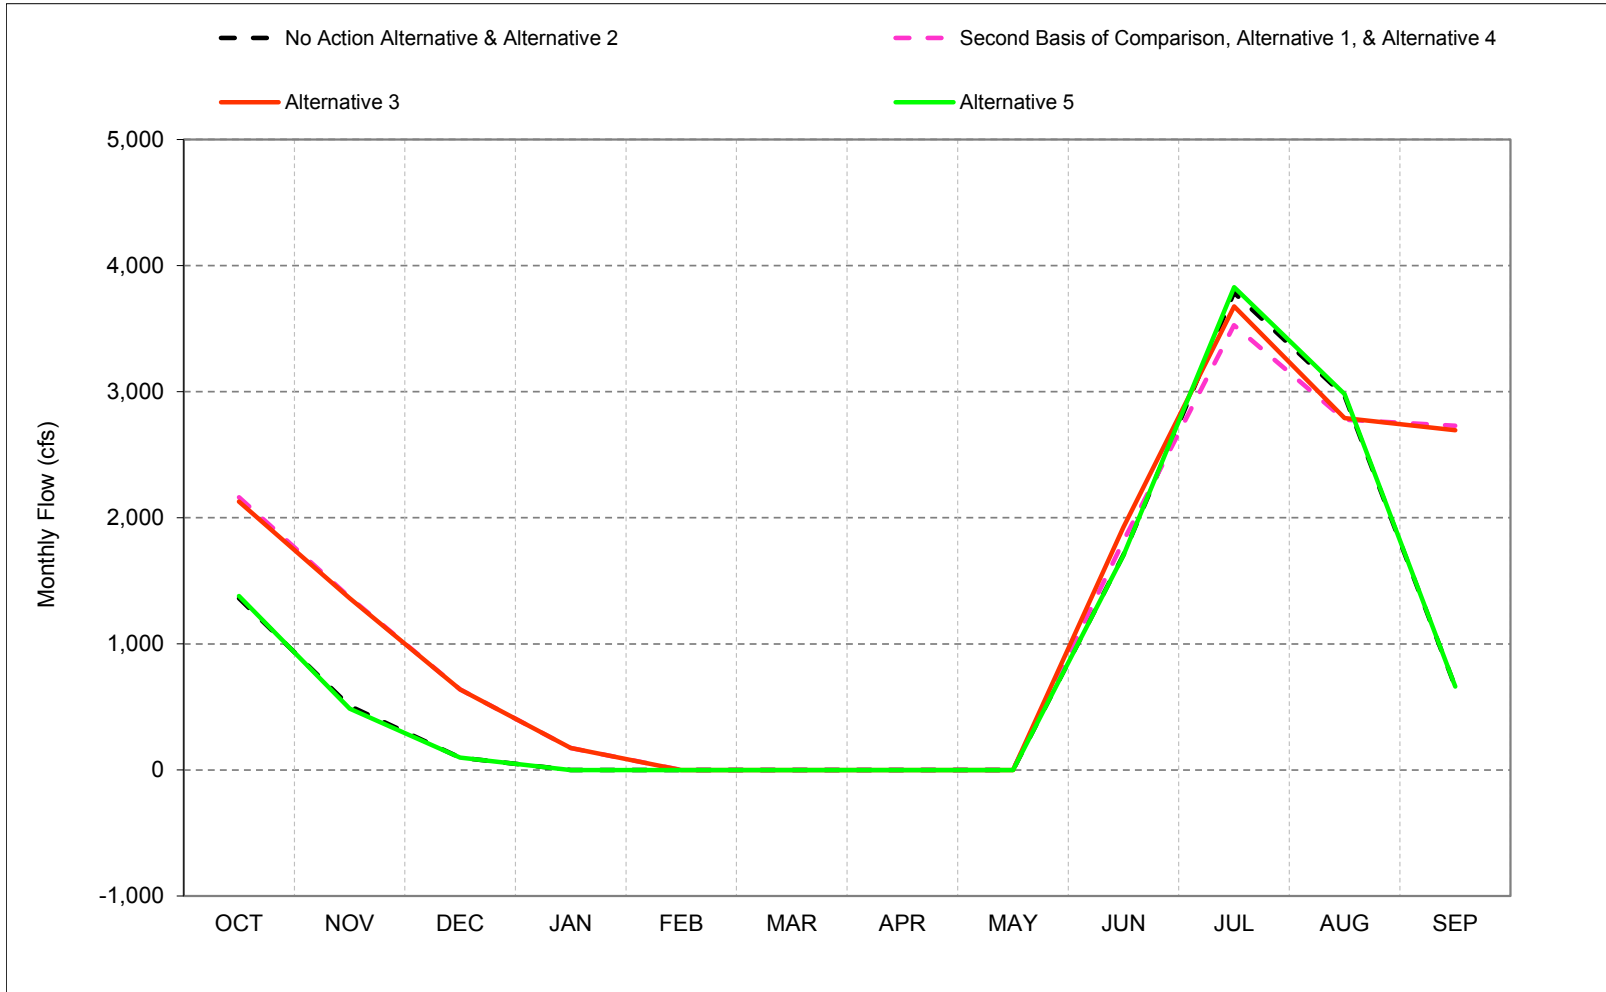


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-31-3. Delta Cross Channel, Above Normal Year* Long-Term** Average Flow

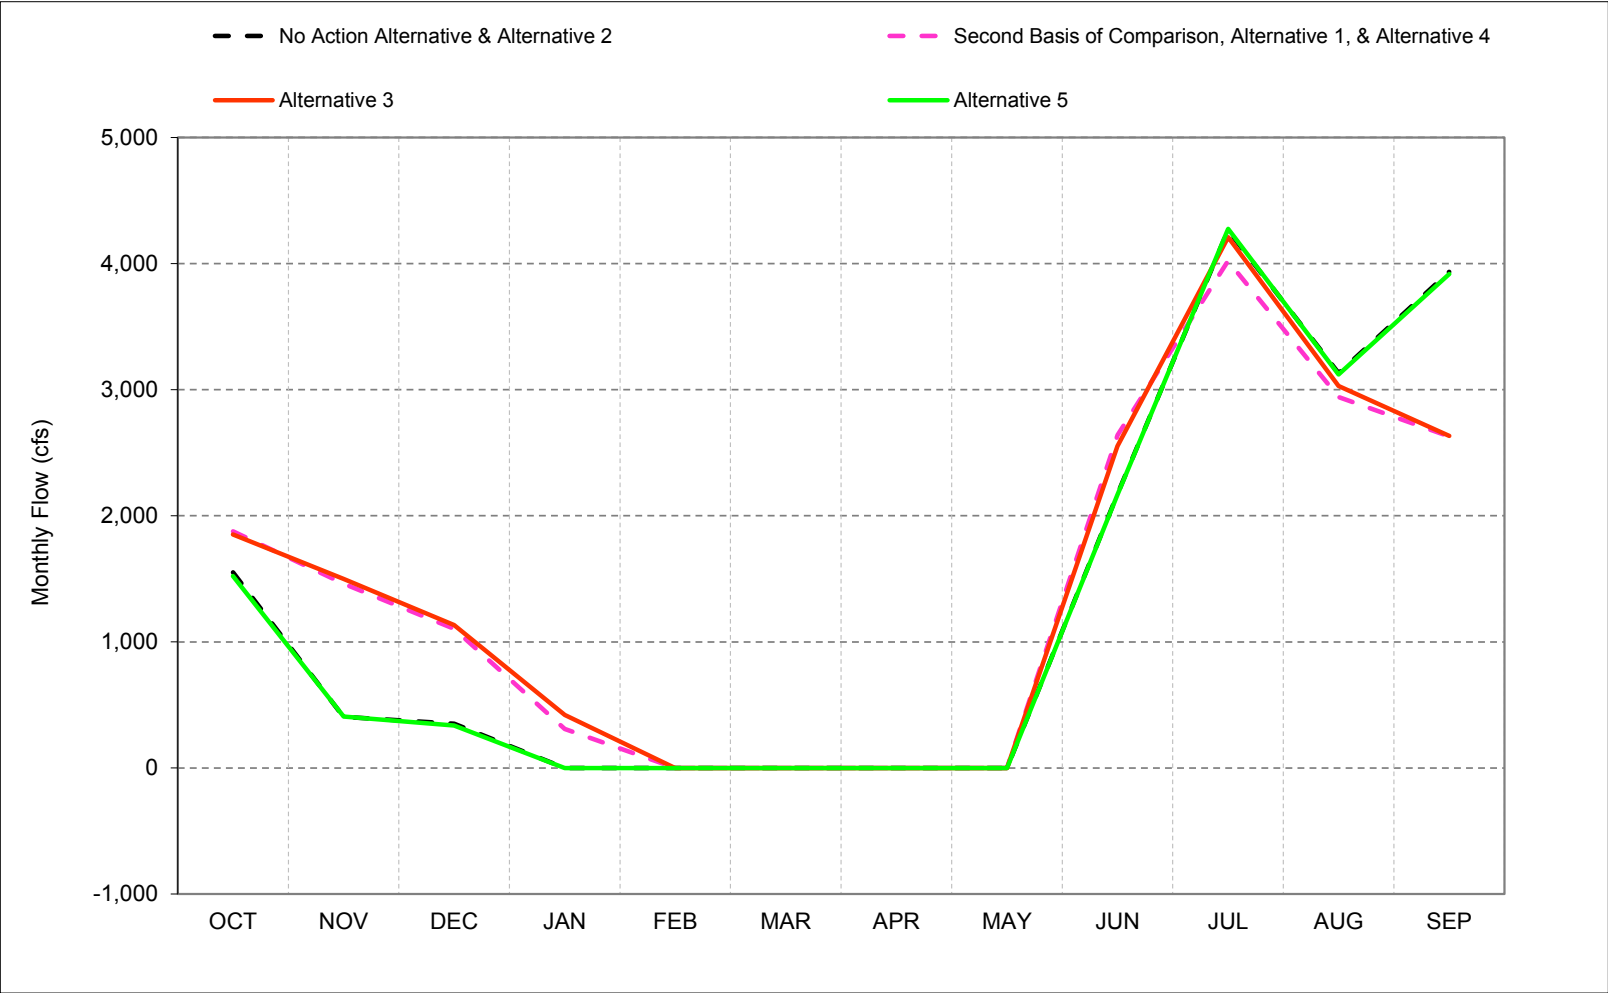


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-31-4. Delta Cross Channel, Below Normal Year* Long-Term** Average Flow

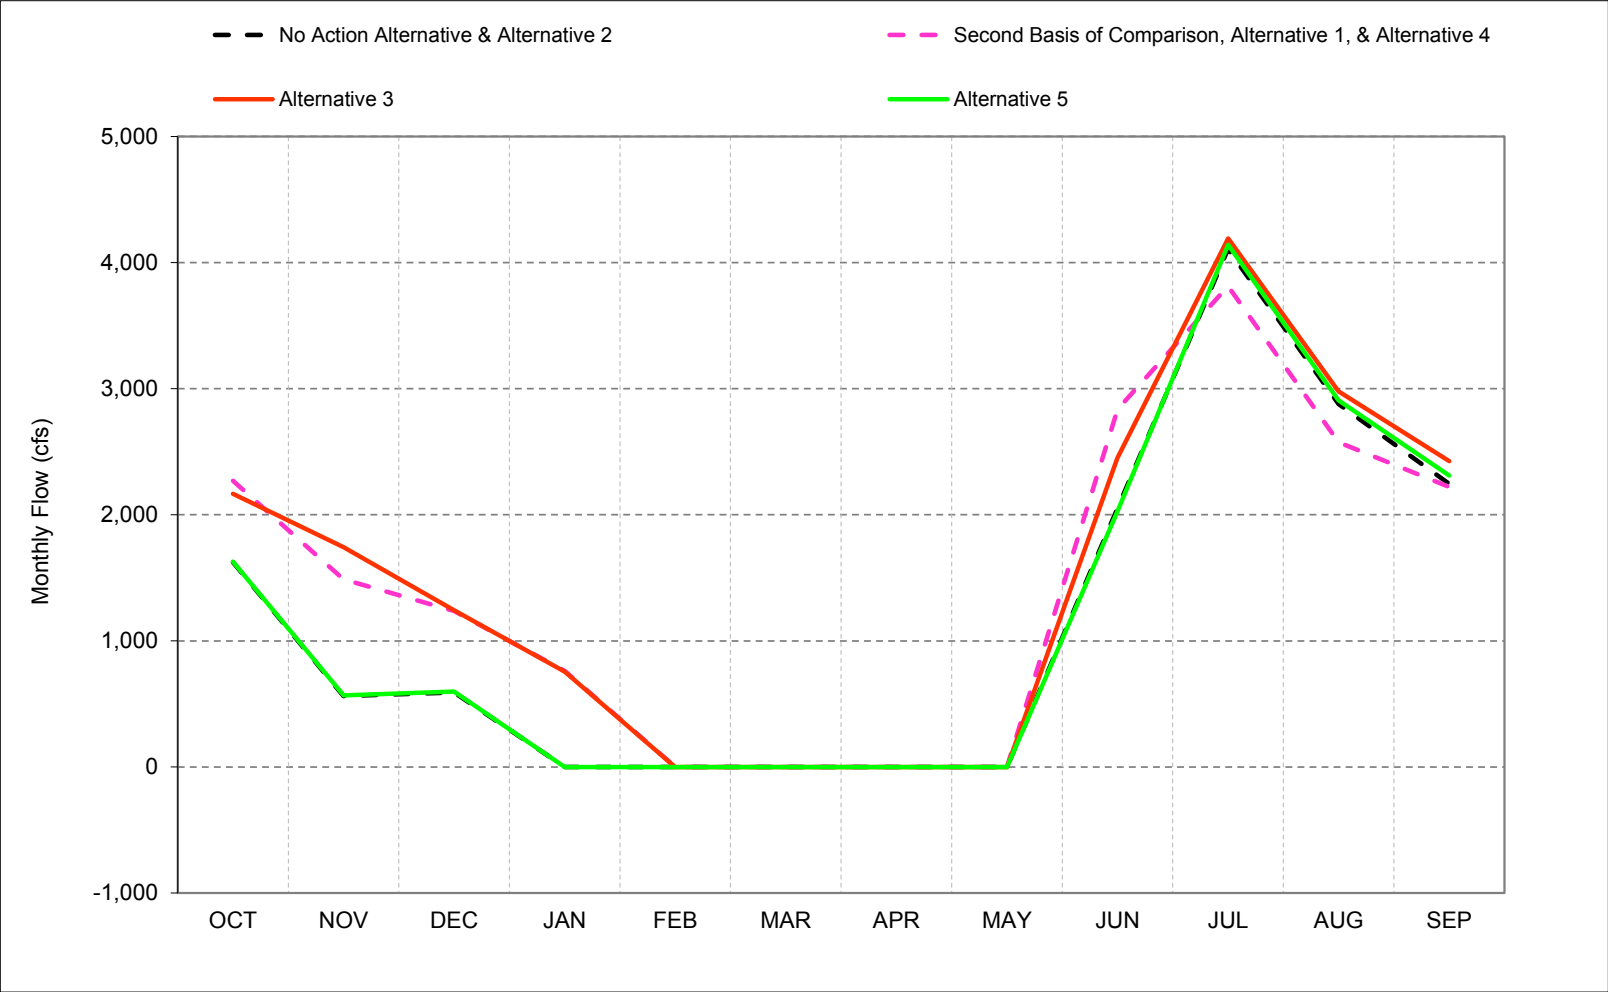


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-31-5. Delta Cross Channel, Dry Year* Long-Term** Average Flow

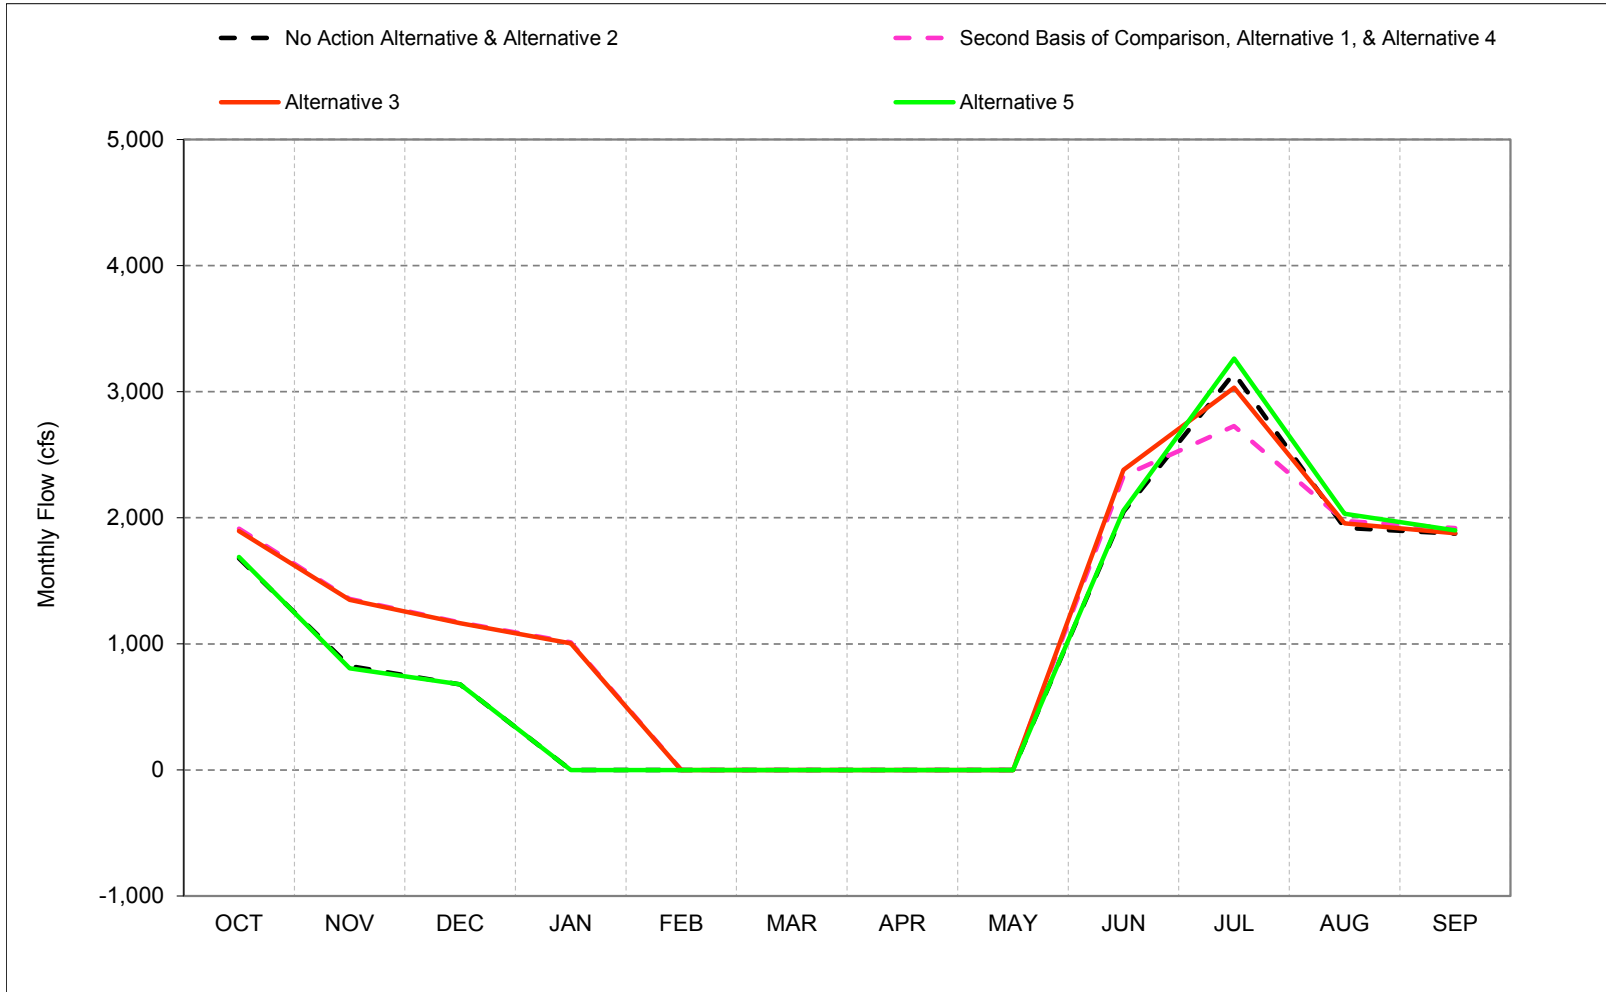


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-31-6. Delta Cross Channel, Critical Year* Long-Term** Average Flow

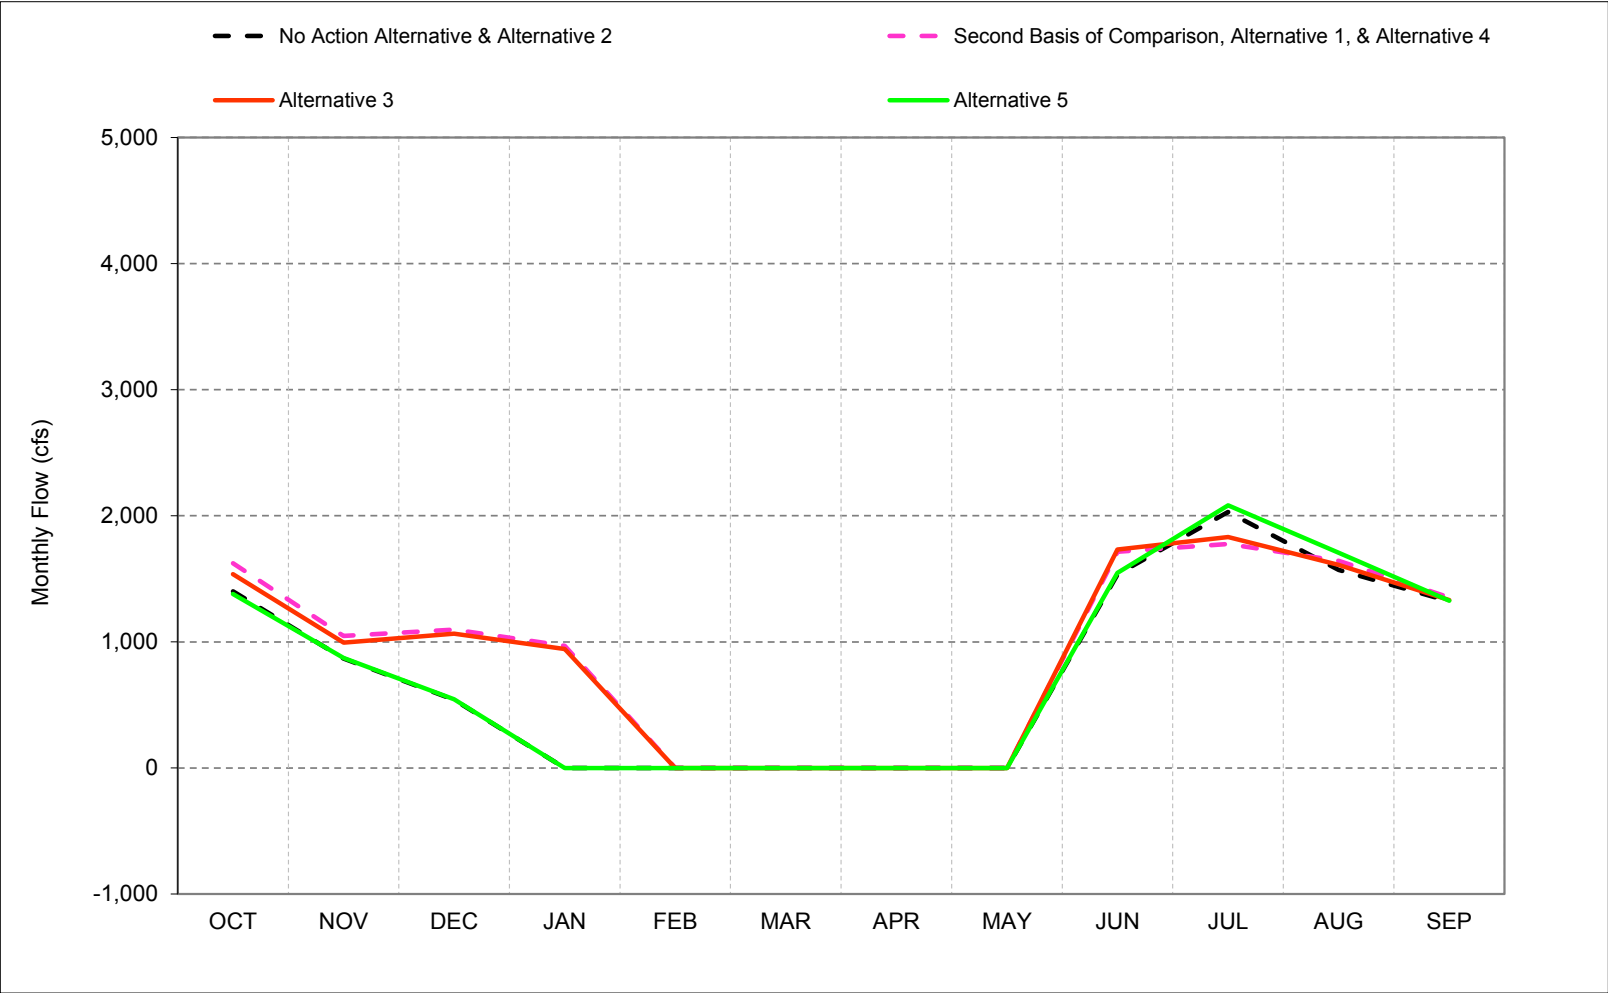

*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-31-1. Delta Cross Channel, Monthly Flow

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,113	1,241	917	0	0	0	0	0	2,565	4,561	3,177	4,016
20%	1,890	1,053	822	0	0	0	0	0	2,240	4,452	3,109	3,318
30%	1,745	953	725	0	0	0	0	0	2,130	4,216	2,999	2,471
40%	1,611	813	627	0	0	0	0	0	2,088	3,867	2,944	1,929
50%	1,494	768	415	0	0	0	0	0	2,004	3,510	2,739	1,632
60%	1,444	474	0	0	0	0	0	0	1,935	3,272	2,577	1,442
70%	1,248	246	0	0	0	0	0	0	1,755	3,086	2,107	1,171
80%	1,142	0	0	0	0	0	0	0	1,615	2,802	1,727	0
90%	986	0	0	0	0	0	0	0	1,176	2,140	1,501	0
Long Term												
Full Simulation Period ^b	1,509	629	411	0	0	0	0	0	1,887	3,491	2,521	1,785
Water Year Types^c												
Wet (32%)	1,362	509	99	0	0	0	0	0	1,709	3,785	2,964	660
Above Normal (16%)	1,552	406	351	0	0	0	0	0	2,175	4,264	3,131	3,933
Below Normal (13%)	1,624	562	591	0	0	0	0	0	2,054	4,106	2,877	2,246
Dry (24%)	1,677	824	678	0	0	0	0	0	2,050	3,146	1,921	1,874
Critical (15%)	1,401	869	542	0	0	0	0	0	1,536	2,030	1,572	1,321

Alternative 1

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,682	1,880	1,855	1,359	0	0	0	0	3,057	4,269	3,079	2,792
20%	2,598	1,713	1,538	1,154	0	0	0	0	2,903	4,011	2,947	2,714
30%	2,387	1,645	1,421	935	0	0	0	0	2,679	3,772	2,844	2,617
40%	2,119	1,509	1,256	868	0	0	0	0	2,495	3,585	2,731	2,582
50%	1,987	1,391	1,094	739	0	0	0	0	2,350	3,385	2,547	2,483
60%	1,839	1,269	936	0	0	0	0	0	2,091	3,068	2,210	2,212
70%	1,642	1,108	781	0	0	0	0	0	1,978	2,681	2,003	1,826
80%	1,468	962	0	0	0	0	0	0	1,840	2,356	1,791	1,591
90%	1,192	768	0	0	0	0	0	0	1,369	1,878	1,565	1,305
Long Term												
Full Simulation Period ^b	1,992	1,350	989	595	0	0	0	0	2,196	3,192	2,415	2,246
Water Year Types^c												
Wet (32%)	2,162	1,371	638	174	0	0	0	0	1,819	3,527	2,779	2,730
Above Normal (16%)	1,877	1,462	1,104	309	0	0	0	0	2,640	4,020	2,941	2,630
Below Normal (13%)	2,270	1,488	1,237	761	0	0	0	0	2,837	3,813	2,575	2,221
Dry (24%)	1,914	1,358	1,170	1,012	0	0	0	0	2,332	2,727	1,975	1,919
Critical (15%)	1,624	1,047	1,096	968	0	0	0	0	1,716	1,776	1,643	1,354

Alternative 1 minus No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	569	638	938	1,359	0	0	0	0	492	-292	-97	-1,224
20%	709	660	716	1,154	0	0	0	0	663	-441	-162	-604
30%	641	692	697	935	0	0	0	0	549	-444	-155	146
40%	507	697	629	868	0	0	0	0	408	-282	-213	653
50%	493	623	679	739	0	0	0	0	346	-125	-193	850
60%	396	795	936	0	0	0	0	0	156	-204	-367	770
70%	394	862	781	0	0	0	0	0	222	-406	-104	655
80%	325	962	0	0	0	0	0	0	225	-446	64	1,591
90%	205	768	0	0	0	0	0	0	192	-262	64	1,305
Long Term												
Full Simulation Period ^b	483	721	578	595	0	0	0	0	309	-299	-106	462
Water Year Types^c												
Wet (32%)	801	862	540	174	0	0	0	0	111	-258	-186	2,069
Above Normal (16%)	325	1,056	753	309	0	0	0	0	465	-244	-190	-1,303
Below Normal (13%)	647	926	646	761	0	0	0	0	783	-293	-301	-25
Dry (24%)	237	534	492	1,012	0	0	0	0	283	-420	54	44
Critical (15%)	224	178	555	968	0	0	0	0	180	-254	71	32

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-31-2. Delta Cross Channel, Monthly Flow

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,113	1,241	917	0	0	0	0	0	2,565	4,561	3,177	4,016
20%	1,890	1,053	822	0	0	0	0	0	2,240	4,452	3,109	3,318
30%	1,745	953	725	0	0	0	0	0	2,130	4,216	2,999	2,471
40%	1,611	813	627	0	0	0	0	0	2,088	3,867	2,944	1,929
50%	1,494	768	415	0	0	0	0	0	2,004	3,510	2,739	1,632
60%	1,444	474	0	0	0	0	0	0	1,935	3,272	2,577	1,442
70%	1,248	246	0	0	0	0	0	0	1,755	3,086	2,107	1,171
80%	1,142	0	0	0	0	0	0	0	1,615	2,802	1,727	0
90%	986	0	0	0	0	0	0	0	1,176	2,140	1,501	0
Long Term												
Full Simulation Period ^b	1,509	629	411	0	0	0	0	0	1,887	3,491	2,521	1,785
Water Year Types^c												
Wet (32%)	1,362	509	99	0	0	0	0	0	1,709	3,785	2,964	660
Above Normal (16%)	1,552	406	351	0	0	0	0	0	2,175	4,264	3,131	3,933
Below Normal (13%)	1,624	562	591	0	0	0	0	0	2,054	4,106	2,877	2,246
Dry (24%)	1,677	824	678	0	0	0	0	0	2,050	3,146	1,921	1,874
Critical (15%)	1,401	869	542	0	0	0	0	0	1,536	2,030	1,572	1,321

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,673	1,943	1,853	1,448	0	0	0	0	3,006	4,466	3,141	2,838
20%	2,573	1,787	1,552	1,160	0	0	0	0	2,654	4,357	3,037	2,735
30%	2,297	1,665	1,422	941	0	0	0	0	2,571	4,228	2,892	2,608
40%	2,123	1,523	1,294	864	0	0	0	0	2,474	3,893	2,818	2,527
50%	1,967	1,388	1,093	746	0	0	0	0	2,354	3,609	2,653	2,463
60%	1,697	1,291	916	0	0	0	0	0	2,265	3,191	2,494	2,287
70%	1,513	1,113	738	0	0	0	0	0	2,000	2,848	2,129	1,840
80%	1,456	961	0	0	0	0	0	0	1,823	2,514	1,765	1,644
90%	1,166	771	0	0	0	0	0	0	1,288	1,902	1,540	1,276
Long Term												
Full Simulation Period ^b	1,946	1,378	989	606	0	0	0	0	2,177	3,402	2,477	2,249
Water Year Types^c												
Wet (32%)	2,129	1,362	639	174	0	0	0	0	1,925	3,676	2,790	2,693
Above Normal (16%)	1,851	1,499	1,134	419	0	0	0	0	2,551	4,209	3,029	2,633
Below Normal (13%)	2,167	1,743	1,242	756	0	0	0	0	2,450	4,191	2,977	2,426
Dry (24%)	1,894	1,350	1,164	1,005	0	0	0	0	2,378	3,031	1,956	1,878
Critical (15%)	1,537	993	1,066	945	0	0	0	0	1,731	1,830	1,611	1,331

Alternative 3 minus No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	561	701	935	1,448	0	0	0	0	441	-95	-36	-1,178
20%	684	734	730	1,160	0	0	0	0	415	-95	-72	-582
30%	551	712	697	941	0	0	0	0	441	12	-107	137
40%	512	711	667	864	0	0	0	0	386	26	-126	598
50%	473	620	678	746	0	0	0	0	350	99	-86	831
60%	253	817	916	0	0	0	0	0	330	-80	-84	845
70%	265	867	738	0	0	0	0	0	244	-238	23	669
80%	314	961	0	0	0	0	0	0	208	-289	38	1,644
90%	180	771	0	0	0	0	0	0	111	-238	39	1,276
Long Term												
Full Simulation Period ^b	436	749	578	606	0	0	0	0	290	-89	-44	465
Water Year Types^c												
Wet (32%)	767	853	540	174	0	0	0	0	216	-109	-175	2,032
Above Normal (16%)	299	1,093	783	419	0	0	0	0	376	-55	-102	-1,301
Below Normal (13%)	544	1,181	651	756	0	0	0	0	396	84	100	180
Dry (24%)	217	525	487	1,005	0	0	0	0	329	-115	35	3
Critical (15%)	137	124	525	945	0	0	0	0	195	-200	39	9

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-31-3. Delta Cross Channel, Monthly Flow

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	2,113	1,241	917	0	0	0	0	0	2,565	4,561	3,177	4,016
20%	1,890	1,053	822	0	0	0	0	0	2,240	4,452	3,109	3,318
30%	1,745	953	725	0	0	0	0	0	2,130	4,216	2,999	2,471
40%	1,611	813	627	0	0	0	0	0	2,088	3,867	2,944	1,929
50%	1,494	768	415	0	0	0	0	0	2,004	3,510	2,739	1,632
60%	1,444	474	0	0	0	0	0	0	1,935	3,272	2,577	1,442
70%	1,248	246	0	0	0	0	0	0	1,755	3,086	2,107	1,171
80%	1,142	0	0	0	0	0	0	0	1,615	2,802	1,727	0
90%	986	0	0	0	0	0	0	0	1,176	2,140	1,501	0
Long Term												
Full Simulation Period ^b	1,509	629	411	0	0	0	0	0	1,887	3,491	2,521	1,785
Water Year Types ^c												
Wet (32%)	1,362	509	99	0	0	0	0	0	1,709	3,785	2,964	660
Above Normal (16%)	1,552	406	351	0	0	0	0	0	2,175	4,264	3,131	3,933
Below Normal (13%)	1,624	562	591	0	0	0	0	0	2,054	4,106	2,877	2,246
Dry (24%)	1,677	824	678	0	0	0	0	0	2,050	3,146	1,921	1,874
Critical (15%)	1,401	869	542	0	0	0	0	0	1,536	2,030	1,572	1,321

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	2,136	1,242	913	0	0	0	0	0	2,583	4,560	3,180	3,993
20%	1,977	1,034	823	0	0	0	0	0	2,241	4,446	3,116	3,329
30%	1,719	952	725	0	0	0	0	0	2,134	4,301	3,000	2,471
40%	1,585	813	639	0	0	0	0	0	2,085	3,897	2,950	1,922
50%	1,491	769	376	0	0	0	0	0	2,010	3,644	2,859	1,673
60%	1,451	386	0	0	0	0	0	0	1,952	3,387	2,687	1,472
70%	1,261	228	0	0	0	0	0	0	1,723	3,219	2,184	1,169
80%	1,161	0	0	0	0	0	0	0	1,606	2,875	1,796	0
90%	988	0	0	0	0	0	0	0	1,186	2,173	1,651	0
Long Term												
Full Simulation Period ^b	1,511	620	410	0	0	0	0	0	1,883	3,547	2,575	1,798
Water Year Types ^c												
Wet (32%)	1,380	487	99	0	0	0	0	0	1,702	3,828	2,981	661
Above Normal (16%)	1,521	407	338	0	0	0	0	0	2,167	4,275	3,120	3,917
Below Normal (13%)	1,628	567	597	0	0	0	0	0	2,026	4,141	2,908	2,312
Dry (24%)	1,690	807	679	0	0	0	0	0	2,057	3,261	2,033	1,899
Critical (15%)	1,379	872	545	0	0	0	0	0	1,548	2,083	1,706	1,327

Alternative 5 minus No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	23	1	-4	0	0	0	0	0	19	0	3	-23
20%	88	-19	1	0	0	0	0	0	1	-6	6	11
30%	-26	-2	0	0	0	0	0	0	5	85	1	0
40%	-26	0	12	0	0	0	0	0	-3	30	7	-7
50%	-3	0	-39	0	0	0	0	0	7	134	119	40
60%	7	-88	0	0	0	0	0	0	17	115	110	30
70%	13	-18	0	0	0	0	0	0	-32	133	77	-2
80%	18	0	0	0	0	0	0	0	-9	72	69	0
90%	1	0	0	0	0	0	0	0	10	33	150	0
Long Term												
Full Simulation Period ^b	1	-10	-1	0	0	0	0	0	-3	56	54	13
Water Year Types ^c												
Wet (32%)	18	-22	0	0	0	0	0	0	-6	43	17	1
Above Normal (16%)	-31	1	-13	0	0	0	0	0	-8	10	-11	-17
Below Normal (13%)	5	5	6	0	0	0	0	0	-28	34	31	66
Dry (24%)	13	-17	1	0	0	0	0	0	8	115	112	25
Critical (15%)	-22	3	3	0	0	0	0	0	12	53	134	6

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-31-4. Delta Cross Channel, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,682	1,880	1,855	1,359	0	0	0	0	3,057	4,269	3,079	2,792
20%	2,598	1,713	1,538	1,154	0	0	0	0	2,903	4,011	2,947	2,714
30%	2,387	1,645	1,421	935	0	0	0	0	2,679	3,772	2,844	2,617
40%	2,119	1,509	1,256	868	0	0	0	0	2,495	3,585	2,731	2,582
50%	1,987	1,391	1,094	739	0	0	0	0	2,350	3,385	2,547	2,483
60%	1,839	1,269	936	0	0	0	0	0	2,091	3,068	2,210	2,212
70%	1,642	1,108	781	0	0	0	0	0	1,978	2,681	2,003	1,826
80%	1,468	962	0	0	0	0	0	0	1,840	2,356	1,791	1,591
90%	1,192	768	0	0	0	0	0	0	1,369	1,878	1,565	1,305
Long Term												
Full Simulation Period ^b	1,992	1,350	989	595	0	0	0	0	2,196	3,192	2,415	2,246
Water Year Types^c												
Wet (32%)	2,162	1,371	638	174	0	0	0	0	1,819	3,527	2,779	2,730
Above Normal (16%)	1,877	1,462	1,104	309	0	0	0	0	2,640	4,020	2,941	2,630
Below Normal (13%)	2,270	1,488	1,237	761	0	0	0	0	2,837	3,813	2,575	2,221
Dry (24%)	1,914	1,358	1,170	1,012	0	0	0	0	2,332	2,727	1,975	1,919
Critical (15%)	1,624	1,047	1,096	968	0	0	0	0	1,716	1,776	1,643	1,354

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,113	1,241	917	0	0	0	0	0	2,565	4,561	3,177	4,016
20%	1,890	1,053	822	0	0	0	0	0	2,240	4,452	3,109	3,318
30%	1,745	953	725	0	0	0	0	0	2,130	4,216	2,999	2,471
40%	1,611	813	627	0	0	0	0	0	2,088	3,867	2,944	1,929
50%	1,494	768	415	0	0	0	0	0	2,004	3,510	2,739	1,632
60%	1,444	474	0	0	0	0	0	0	1,935	3,272	2,577	1,442
70%	1,248	246	0	0	0	0	0	0	1,755	3,086	2,107	1,171
80%	1,142	0	0	0	0	0	0	0	1,615	2,802	1,727	0
90%	986	0	0	0	0	0	0	0	1,176	2,140	1,501	0
Long Term												
Full Simulation Period ^b	1,509	629	411	0	0	0	0	0	1,887	3,491	2,521	1,785
Water Year Types^c												
Wet (32%)	1,362	509	99	0	0	0	0	0	1,709	3,785	2,964	660
Above Normal (16%)	1,552	406	351	0	0	0	0	0	2,175	4,264	3,131	3,933
Below Normal (13%)	1,624	562	591	0	0	0	0	0	2,054	4,106	2,877	2,246
Dry (24%)	1,677	824	678	0	0	0	0	0	2,050	3,146	1,921	1,874
Critical (15%)	1,401	869	542	0	0	0	0	0	1,536	2,030	1,572	1,321

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-569	-638	-938	-1,359	0	0	0	0	-492	292	97	1,224
20%	-709	-660	-716	-1,154	0	0	0	0	-663	441	162	604
30%	-641	-692	-697	-935	0	0	0	0	-549	444	155	-146
40%	-507	-697	-629	-868	0	0	0	0	-408	282	213	-653
50%	-493	-623	-679	-739	0	0	0	0	-346	125	193	-850
60%	-396	-795	-936	0	0	0	0	0	-156	204	367	-770
70%	-394	-862	-781	0	0	0	0	0	-222	406	104	-655
80%	-325	-962	0	0	0	0	0	0	-225	446	-64	-1,591
90%	-205	-768	0	0	0	0	0	0	-192	262	-64	-1,305
Long Term												
Full Simulation Period ^b	-483	-721	-578	-595	0	0	0	0	-309	299	106	-462
Water Year Types^c												
Wet (32%)	-801	-862	-540	-174	0	0	0	0	-111	258	186	-2,069
Above Normal (16%)	-325	-1,056	-753	-309	0	0	0	0	-465	244	190	1,303
Below Normal (13%)	-647	-926	-646	-761	0	0	0	0	-783	293	301	25
Dry (24%)	-237	-534	-492	-1,012	0	0	0	0	-283	420	-54	-44
Critical (15%)	-224	-178	-555	-968	0	0	0	0	-180	254	-71	-32

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-31-5. Delta Cross Channel, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	2,682	1,880	1,855	1,359	0	0	0	0	3,057	4,269	3,079	2,792
20%	2,598	1,713	1,538	1,154	0	0	0	0	2,903	4,011	2,947	2,714
30%	2,387	1,645	1,421	935	0	0	0	0	2,679	3,772	2,844	2,617
40%	2,119	1,509	1,256	868	0	0	0	0	2,495	3,585	2,731	2,582
50%	1,987	1,391	1,094	739	0	0	0	0	2,350	3,385	2,547	2,483
60%	1,839	1,269	936	0	0	0	0	0	2,091	3,068	2,210	2,212
70%	1,642	1,108	781	0	0	0	0	0	1,978	2,681	2,003	1,826
80%	1,468	962	0	0	0	0	0	0	1,840	2,356	1,791	1,591
90%	1,192	768	0	0	0	0	0	0	1,369	1,878	1,565	1,305
Long Term												
Full Simulation Period ^b	1,992	1,350	989	595	0	0	0	0	2,196	3,192	2,415	2,246
Water Year Types ^c												
Wet (32%)	2,162	1,371	638	174	0	0	0	0	1,819	3,527	2,779	2,730
Above Normal (16%)	1,877	1,462	1,104	309	0	0	0	0	2,640	4,020	2,941	2,630
Below Normal (13%)	2,270	1,488	1,237	761	0	0	0	0	2,837	3,813	2,575	2,221
Dry (24%)	1,914	1,358	1,170	1,012	0	0	0	0	2,332	2,727	1,975	1,919
Critical (15%)	1,624	1,047	1,096	968	0	0	0	0	1,716	1,776	1,643	1,354

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	2,673	1,943	1,853	1,448	0	0	0	0	3,006	4,466	3,141	2,838
20%	2,573	1,787	1,552	1,160	0	0	0	0	2,654	4,357	3,037	2,735
30%	2,297	1,665	1,422	941	0	0	0	0	2,571	4,228	2,892	2,608
40%	2,123	1,523	1,294	864	0	0	0	0	2,474	3,893	2,818	2,527
50%	1,967	1,388	1,093	746	0	0	0	0	2,354	3,609	2,653	2,463
60%	1,697	1,291	916	0	0	0	0	0	2,265	3,191	2,494	2,287
70%	1,513	1,113	738	0	0	0	0	0	2,000	2,848	2,129	1,840
80%	1,456	961	0	0	0	0	0	0	1,823	2,514	1,765	1,644
90%	1,166	771	0	0	0	0	0	0	1,288	1,902	1,540	1,276
Long Term												
Full Simulation Period ^b	1,946	1,378	989	606	0	0	0	0	2,177	3,402	2,477	2,249
Water Year Types ^c												
Wet (32%)	2,129	1,362	639	174	0	0	0	0	1,925	3,676	2,790	2,693
Above Normal (16%)	1,851	1,499	1,134	419	0	0	0	0	2,551	4,209	3,029	2,633
Below Normal (13%)	2,167	1,743	1,242	756	0	0	0	0	2,450	4,191	2,977	2,426
Dry (24%)	1,894	1,350	1,164	1,005	0	0	0	0	2,378	3,031	1,956	1,878
Critical (15%)	1,537	993	1,066	945	0	0	0	0	1,731	1,830	1,611	1,331

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-8	63	-3	89	0	0	0	0	-51	197	62	47
20%	-25	74	14	6	0	0	0	0	-248	347	90	22
30%	-90	20	0	6	0	0	0	0	-108	456	48	-9
40%	4	14	38	-4	0	0	0	0	-21	308	88	-55
50%	-21	-3	-1	7	0	0	0	0	4	224	106	-19
60%	-142	22	-20	0	0	0	0	0	174	123	284	75
70%	-129	5	-44	0	0	0	0	0	22	168	127	14
80%	-12	-1	0	0	0	0	0	0	-18	157	-26	54
90%	-25	3	0	0	0	0	0	0	-81	24	-25	-30
Long Term												
Full Simulation Period ^b	-46	27	0	12	0	0	0	0	-19	210	62	3
Water Year Types ^c												
Wet (32%)	-34	-9	0	0	0	0	0	0	105	149	11	-37
Above Normal (16%)	-26	38	30	110	0	0	0	0	-89	189	87	3
Below Normal (13%)	-103	255	5	-4	0	0	0	0	-388	378	402	205
Dry (24%)	-20	-8	-6	-7	0	0	0	0	46	305	-19	-41
Critical (15%)	-87	-54	-30	-24	0	0	0	0	16	54	-32	-23

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-31-6. Delta Cross Channel, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	2,682	1,880	1,855	1,359	0	0	0	0	3,057	4,269	3,079	2,792
20%	2,598	1,713	1,538	1,154	0	0	0	0	2,903	4,011	2,947	2,714
30%	2,387	1,645	1,421	935	0	0	0	0	2,679	3,772	2,844	2,617
40%	2,119	1,509	1,256	868	0	0	0	0	2,495	3,585	2,731	2,582
50%	1,987	1,391	1,094	739	0	0	0	0	2,350	3,385	2,547	2,483
60%	1,839	1,269	936	0	0	0	0	0	2,091	3,068	2,210	2,212
70%	1,642	1,108	781	0	0	0	0	0	1,978	2,681	2,003	1,826
80%	1,468	962	0	0	0	0	0	0	1,840	2,356	1,791	1,591
90%	1,192	768	0	0	0	0	0	0	1,369	1,878	1,565	1,305
Long Term												
Full Simulation Period ^b	1,992	1,350	989	595	0	0	0	0	2,196	3,192	2,415	2,246
Water Year Types ^c												
Wet (32%)	2,162	1,371	638	174	0	0	0	0	1,819	3,527	2,779	2,730
Above Normal (16%)	1,877	1,462	1,104	309	0	0	0	0	2,640	4,020	2,941	2,630
Below Normal (13%)	2,270	1,488	1,237	761	0	0	0	0	2,837	3,813	2,575	2,221
Dry (24%)	1,914	1,358	1,170	1,012	0	0	0	0	2,332	2,727	1,975	1,919
Critical (15%)	1,624	1,047	1,096	968	0	0	0	0	1,716	1,776	1,643	1,354

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	2,136	1,242	913	0	0	0	0	0	2,583	4,560	3,180	3,993
20%	1,977	1,034	823	0	0	0	0	0	2,241	4,446	3,116	3,329
30%	1,719	952	725	0	0	0	0	0	2,134	4,301	3,000	2,471
40%	1,585	813	639	0	0	0	0	0	2,085	3,897	2,950	1,922
50%	1,491	769	376	0	0	0	0	0	2,010	3,644	2,859	1,673
60%	1,451	386	0	0	0	0	0	0	1,952	3,387	2,687	1,472
70%	1,261	228	0	0	0	0	0	0	1,723	3,219	2,184	1,169
80%	1,161	0	0	0	0	0	0	0	1,606	2,875	1,796	0
90%	988	0	0	0	0	0	0	0	1,186	2,173	1,651	0
Long Term												
Full Simulation Period ^b	1,511	620	410	0	0	0	0	0	1,883	3,547	2,575	1,798
Water Year Types ^c												
Wet (32%)	1,380	487	99	0	0	0	0	0	1,702	3,828	2,981	661
Above Normal (16%)	1,521	407	338	0	0	0	0	0	2,167	4,275	3,120	3,917
Below Normal (13%)	1,628	567	597	0	0	0	0	0	2,026	4,141	2,908	2,312
Dry (24%)	1,690	807	679	0	0	0	0	0	2,057	3,261	2,033	1,899
Critical (15%)	1,379	872	545	0	0	0	0	0	1,548	2,083	1,706	1,327

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-546	-637	-942	-1,359	0	0	0	0	-474	291	100	1,201
20%	-621	-679	-715	-1,154	0	0	0	0	-662	435	169	615
30%	-668	-694	-697	-935	0	0	0	0	-545	529	156	-146
40%	-533	-696	-617	-868	0	0	0	0	-410	312	220	-660
50%	-496	-623	-718	-739	0	0	0	0	-339	259	312	-810
60%	-388	-883	-936	0	0	0	0	0	-139	319	477	-740
70%	-381	-880	-781	0	0	0	0	0	-254	539	181	-657
80%	-307	-962	0	0	0	0	0	0	-234	518	5	-1,591
90%	-204	-768	0	0	0	0	0	0	-182	296	86	-1,305
Long Term												
Full Simulation Period ^b	-481	-731	-579	-595	0	0	0	0	-313	355	160	-448
Water Year Types ^c												
Wet (32%)	-783	-884	-540	-174	0	0	0	0	-117	301	202	-2,069
Above Normal (16%)	-356	-1,054	-766	-309	0	0	0	0	-473	254	178	1,287
Below Normal (13%)	-642	-921	-640	-761	0	0	0	0	-811	328	332	91
Dry (24%)	-224	-551	-491	-1,012	0	0	0	0	-275	535	58	-19
Critical (15%)	-245	-175	-552	-968	0	0	0	0	-168	307	64	-26

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1 **C.32. Sutter and Steamboat Slough Flows**


Figure C-32-1. Sutter and Steamboat Slough, Long-Term* Average Flow

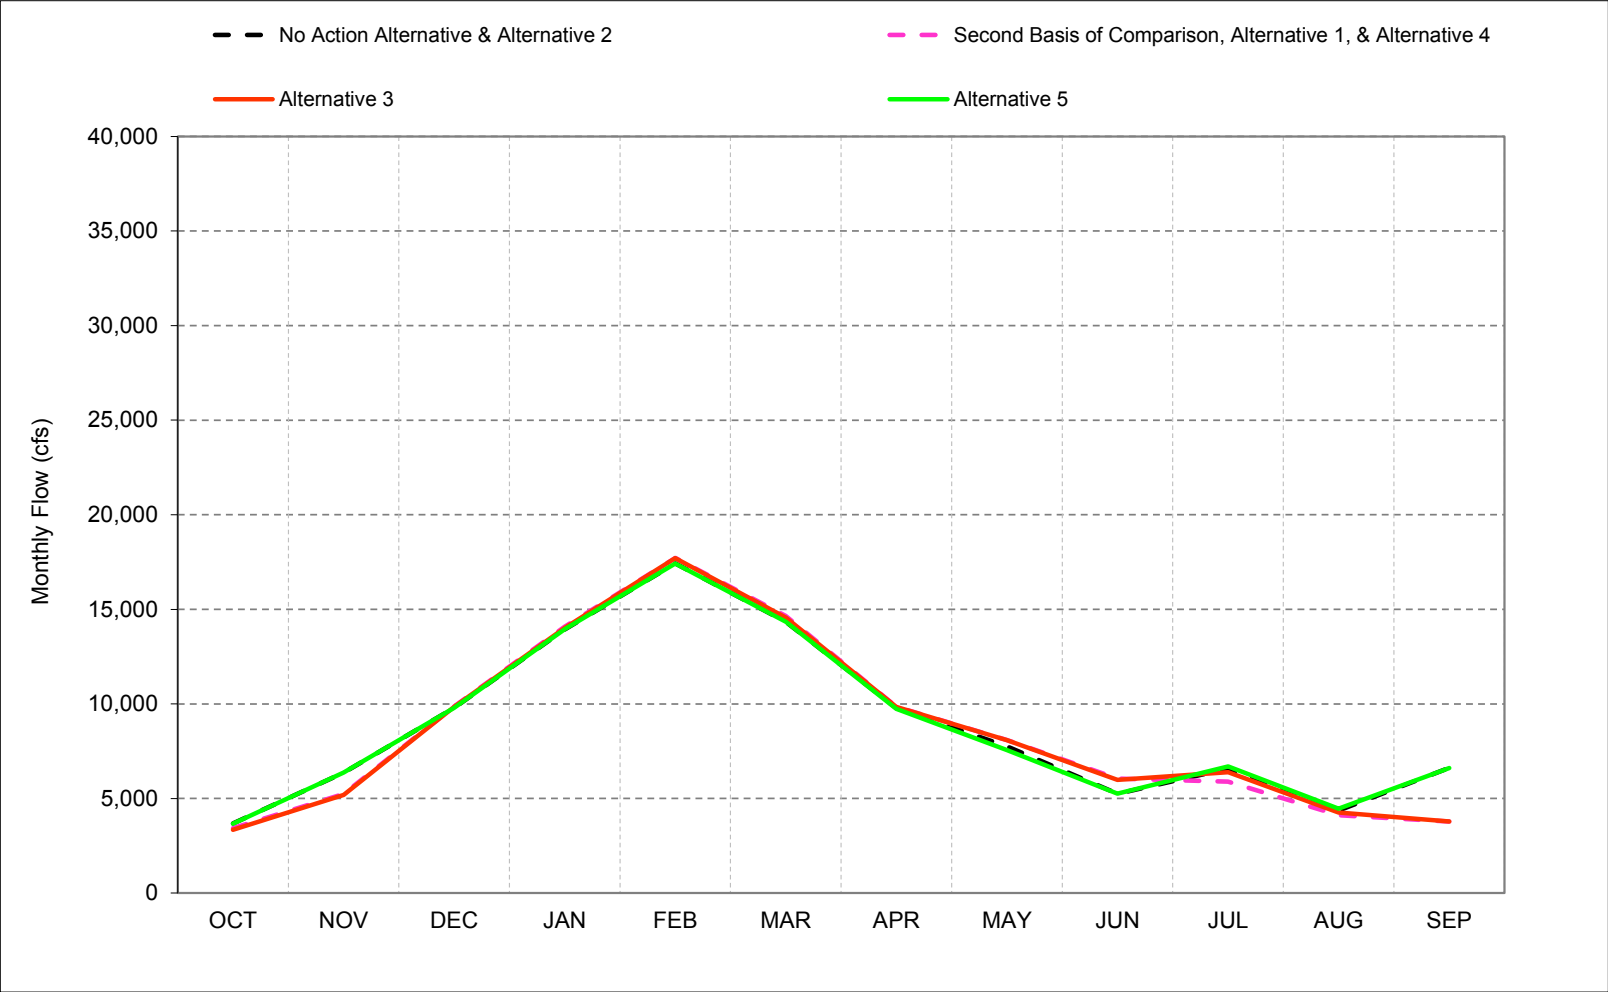

*Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-32-2. Sutter and Steamboat Slough, Wet Year* Long-Term** Average Flow

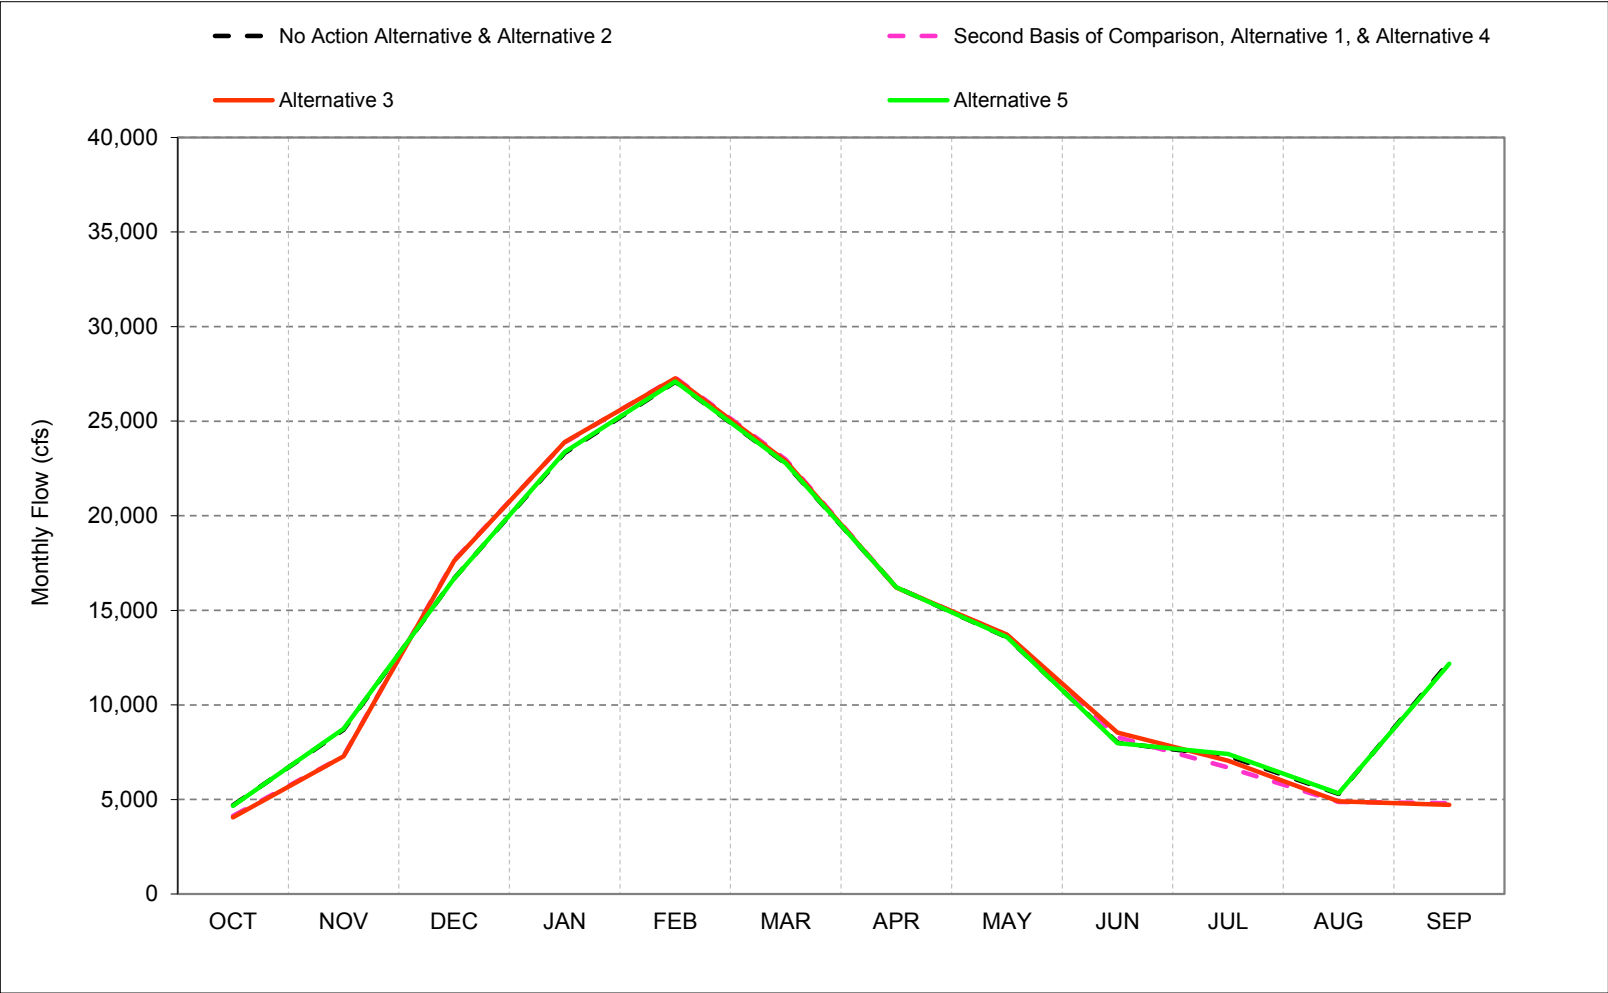


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-32-3. Sutter and Steamboat Slough, Above Normal Year* Long-Term** Average Flow

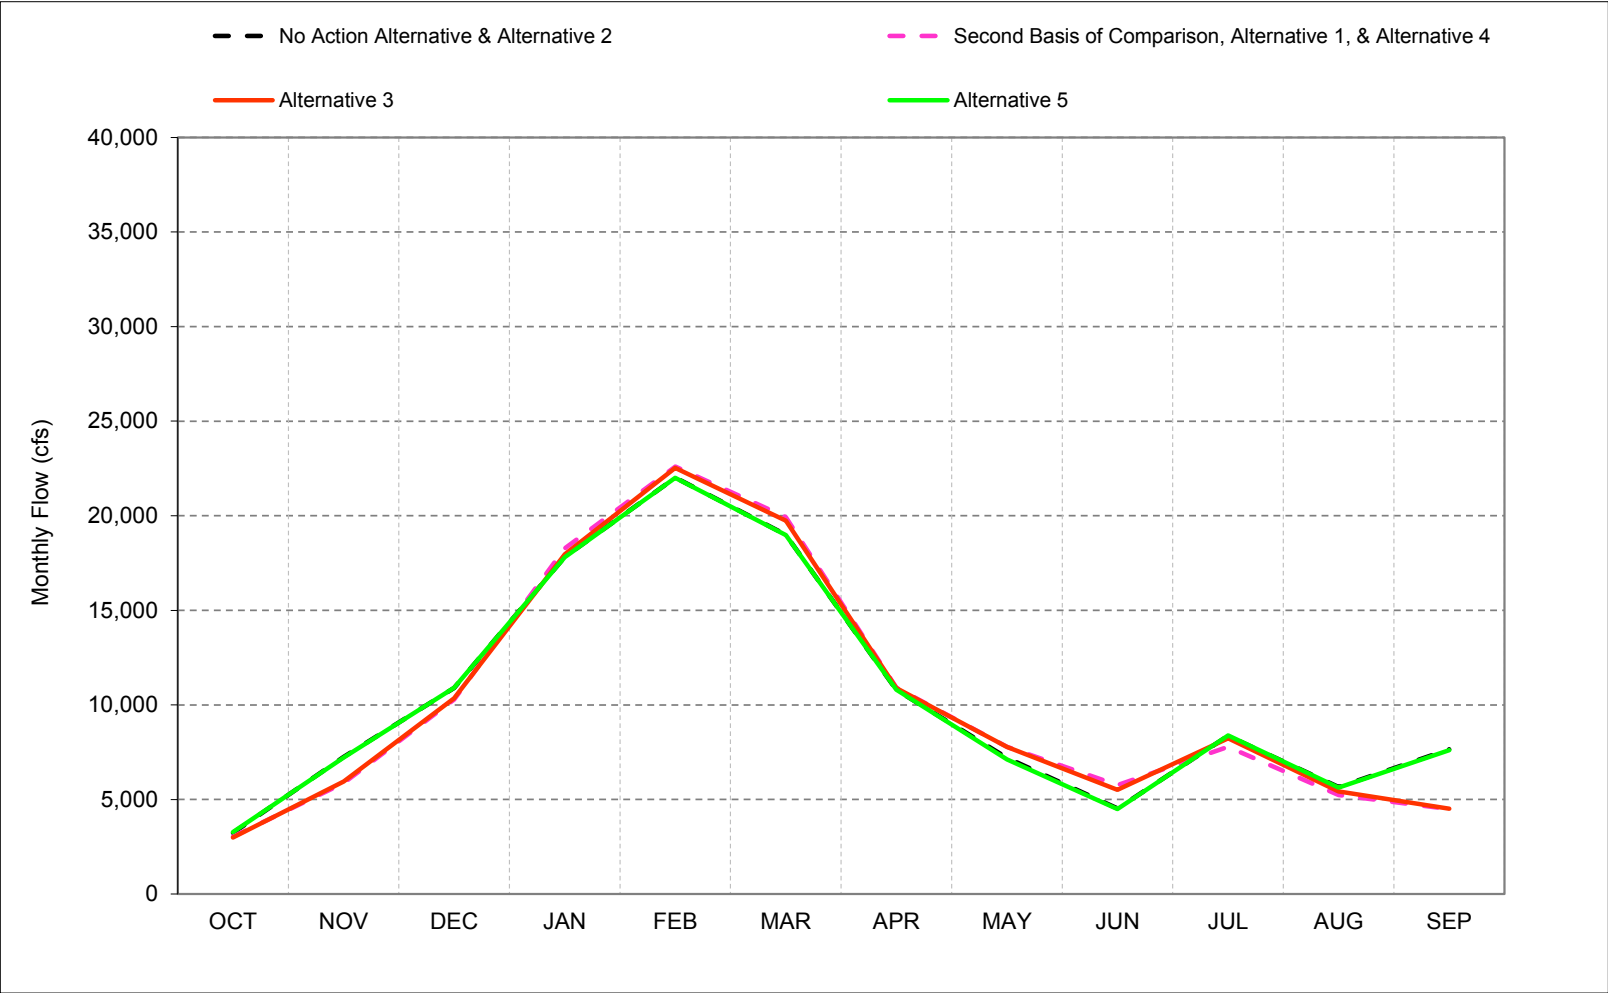


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-32-4. Sutter and Steamboat Slough, Below Normal Year* Long-Term** Average Flow

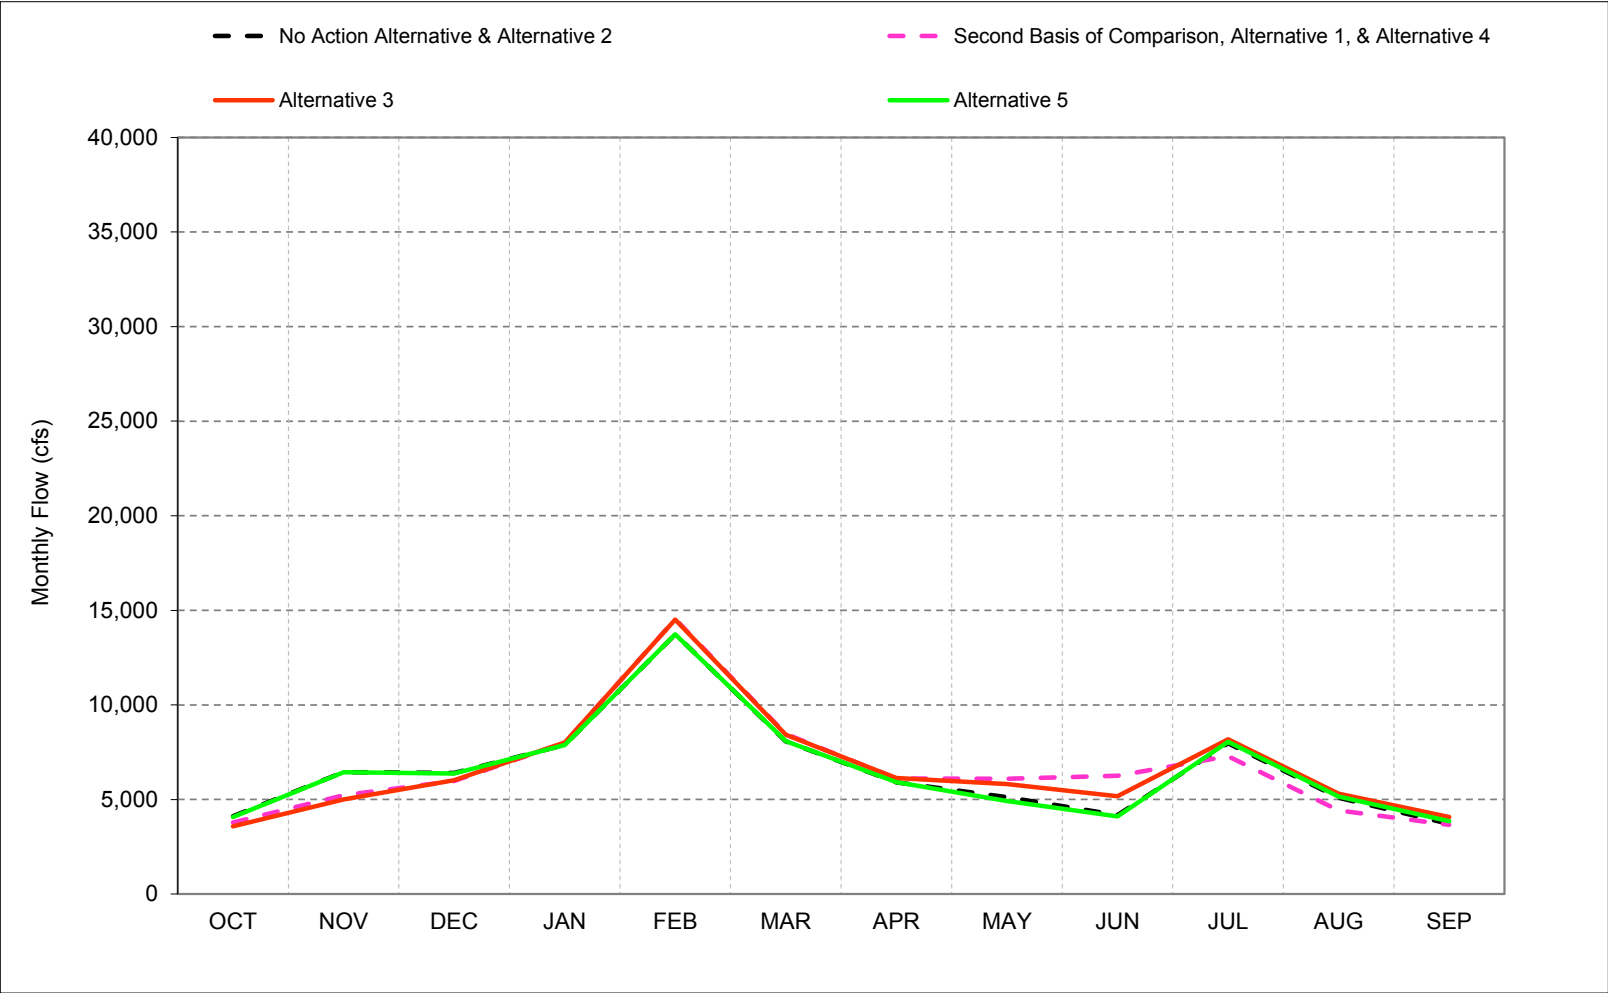


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-32-5. Sutter and Steamboat Slough, Dry Year* Long-Term** Average Flow

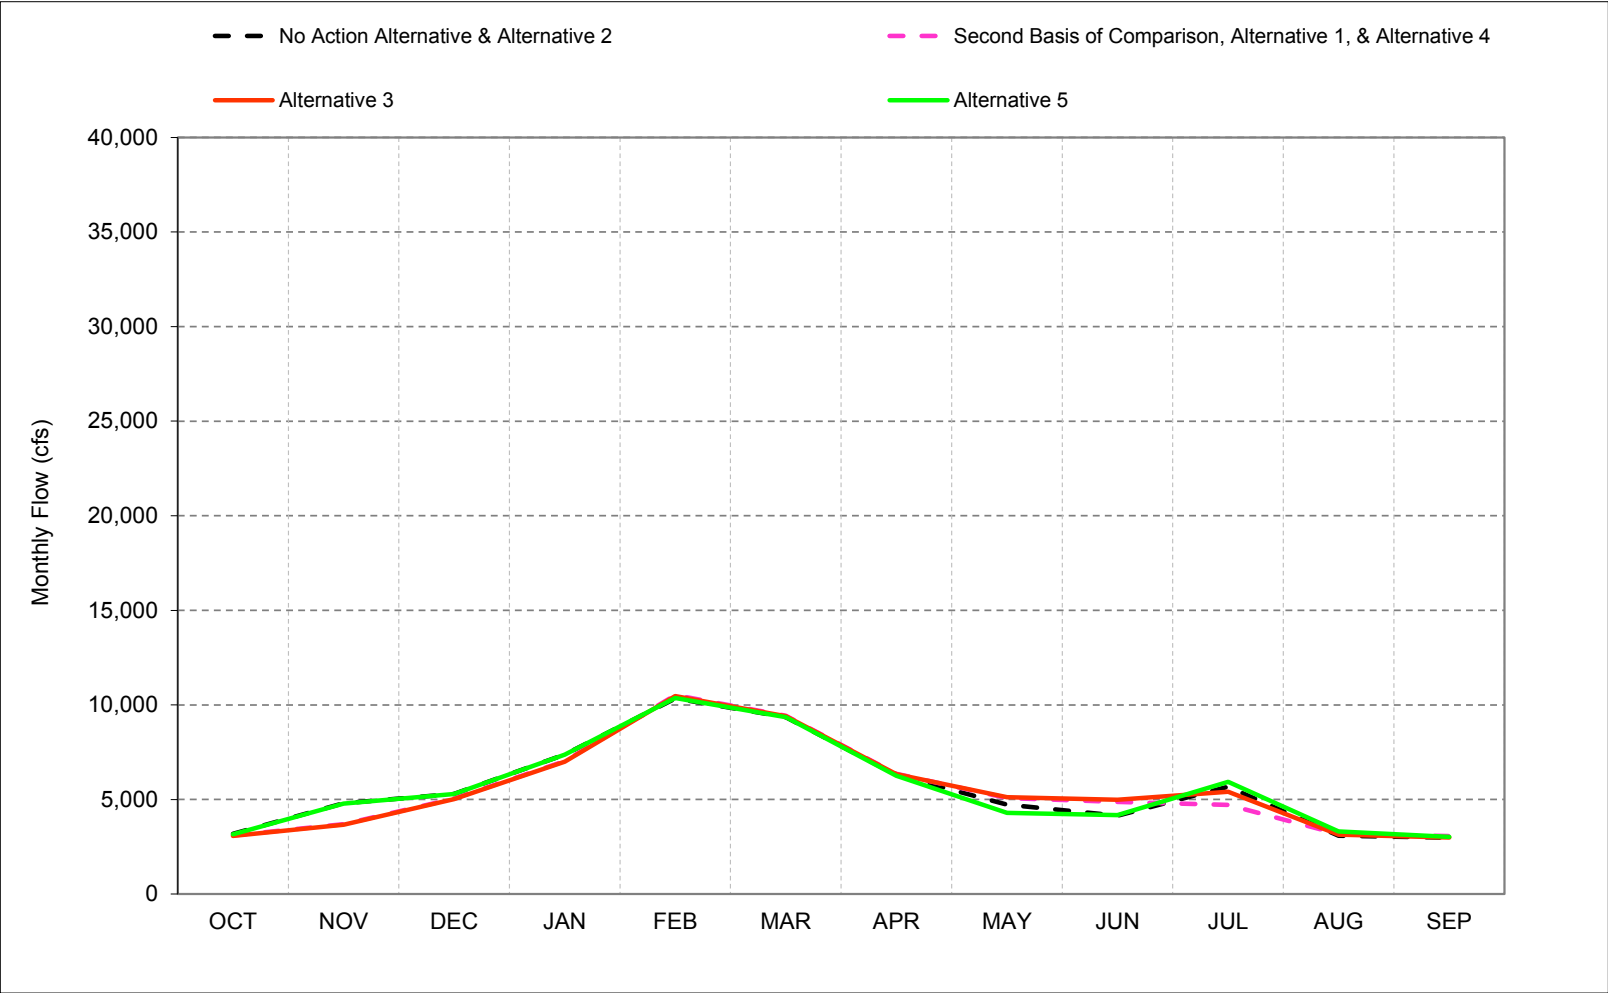


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-32-6. Sutter and Steamboat Slough, Critical Year* Long-Term** Average Flow

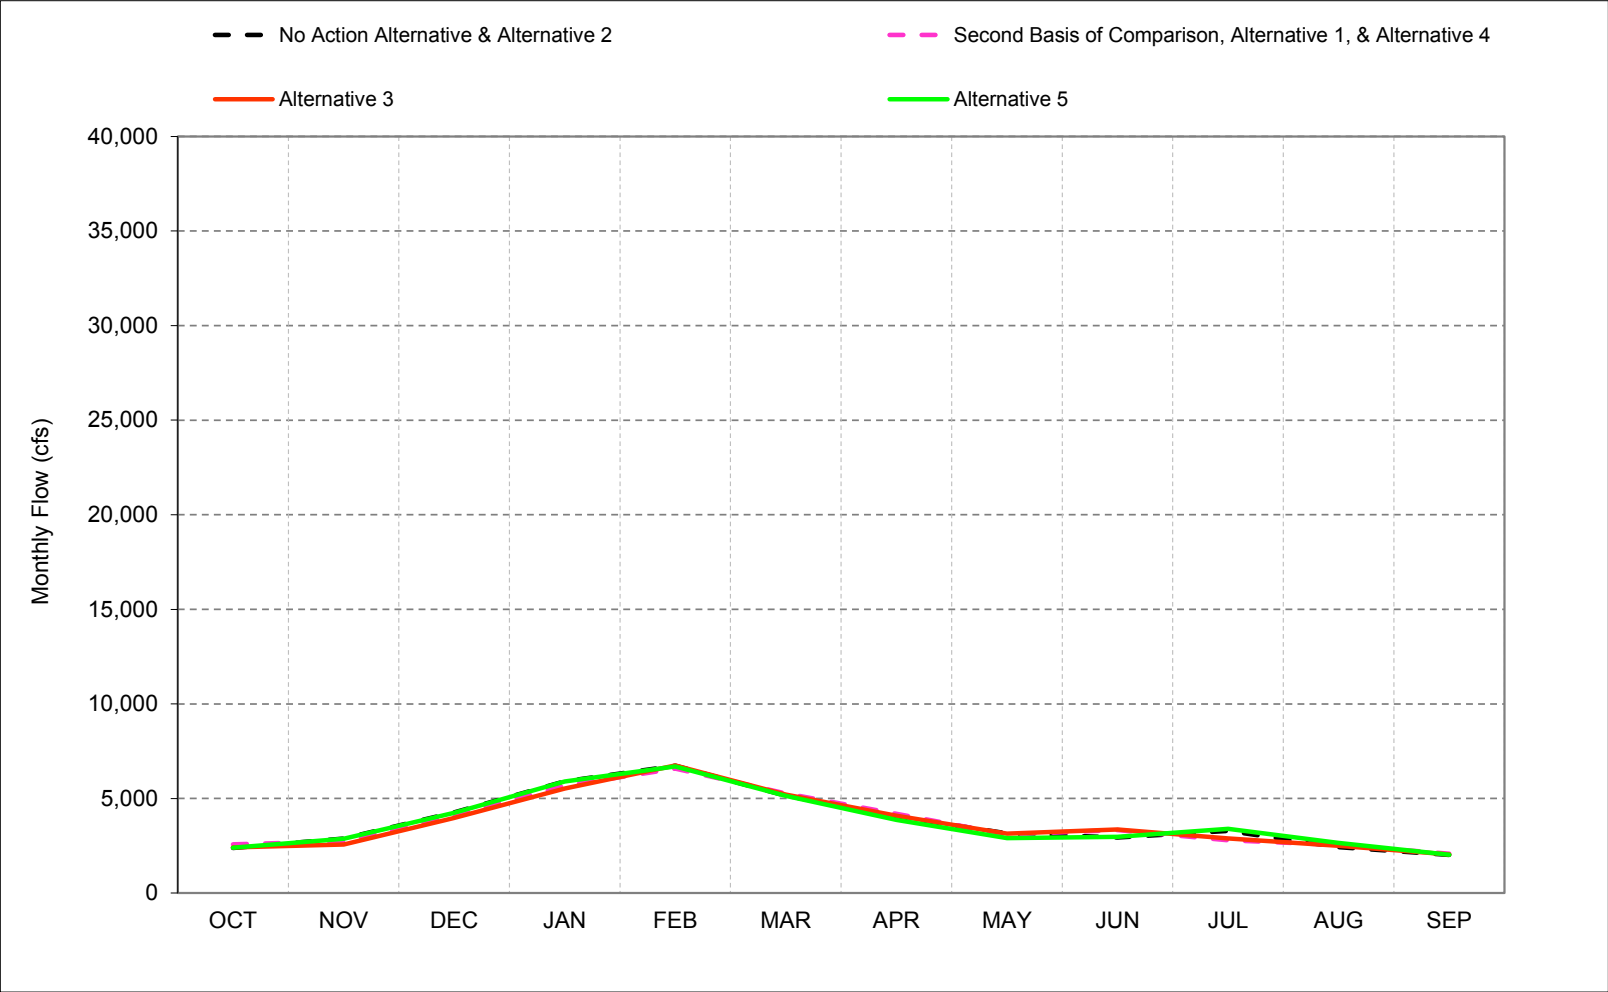

*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-32-1. Sutter and Steamboat Slough, Monthly Flow

No Action Alternative & Alternative 2												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	5,638	9,919	22,841	30,715	34,265	29,738	21,623	17,660	7,388	9,072	5,798	13,044
20%	5,118	8,100	14,561	24,952	29,584	24,030	14,768	11,502	5,656	8,823	5,613	12,752
30%	4,445	7,825	9,289	17,508	23,047	16,979	10,185	7,102	4,575	8,224	5,352	8,255
40%	3,969	6,762	7,709	10,939	19,729	13,223	8,773	5,574	4,298	7,420	5,249	7,773
50%	3,370	5,910	6,296	9,129	14,750	10,865	6,774	4,994	4,232	6,552	4,790	4,655
60%	2,635	4,713	5,846	7,832	10,867	9,111	5,302	4,528	4,067	6,086	4,392	3,813
70%	2,379	3,412	5,350	6,231	8,435	8,001	4,678	4,374	3,812	5,689	3,357	2,914
80%	2,250	2,743	3,796	5,556	6,943	6,224	4,254	4,044	3,359	4,870	2,687	2,371
90%	1,805	2,331	3,187	4,712	5,838	4,541	3,788	3,408	3,114	3,427	2,335	1,940
Long Term												
Full Simulation Period ^b	3,683	6,361	9,793	13,944	17,426	14,344	9,777	7,750	5,259	6,577	4,367	6,623
Water Year Types ^c												
Wet (32%)	4,698	8,688	16,691	23,326	27,078	22,752	16,223	13,578	7,999	7,304	5,292	12,260
Above Normal (16%)	3,238	7,246	10,898	17,822	22,015	19,003	10,799	7,201	4,525	8,363	5,657	7,657
Below Normal (13%)	4,119	6,441	6,401	7,889	13,734	8,070	5,902	5,121	4,183	7,975	5,088	3,714
Dry (24%)	3,189	4,806	5,295	7,376	10,343	9,354	6,297	4,734	4,153	5,670	3,092	2,985
Critical (15%)	2,392	2,881	4,260	5,913	6,733	5,150	4,058	3,153	2,947	3,294	2,430	2,020
Alternative 1												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	4,649	8,840	25,683	31,237	34,303	30,702	21,643	17,648	7,769	8,400	5,588	4,885
20%	4,462	5,375	15,531	26,676	29,803	24,242	14,740	12,352	6,848	7,765	5,301	4,690
30%	4,036	4,788	8,986	19,028	24,301	19,273	10,157	7,389	6,374	7,223	5,023	4,489
40%	3,478	4,540	7,230	11,878	21,140	13,509	8,783	6,343	5,760	6,752	4,743	4,405
50%	3,213	4,085	5,858	9,554	15,013	11,030	6,949	5,561	5,277	6,271	4,326	4,186
60%	2,961	3,716	5,257	7,428	10,947	9,190	5,286	5,226	4,945	5,615	3,628	3,595
70%	2,608	3,328	4,481	5,870	8,705	8,062	4,739	4,793	4,229	4,603	3,209	2,840
80%	2,277	2,840	3,740	5,110	7,084	6,387	4,461	4,306	4,016	3,932	2,803	2,441
90%	1,891	2,345	3,143	4,381	5,968	4,614	4,053	3,378	3,595	2,947	2,385	1,997
Long Term												
Full Simulation Period ^b	3,435	5,243	9,859	14,083	17,717	14,650	9,854	8,085	6,059	5,895	4,116	3,779
Water Year Types ^c												
Wet (32%)	4,134	7,289	17,643	23,870	27,298	22,969	16,213	13,686	8,296	6,695	4,872	4,797
Above Normal (16%)	3,037	5,861	10,293	18,272	22,598	19,927	10,909	7,780	5,769	7,790	5,239	4,495
Below Normal (13%)	3,787	5,220	5,987	8,000	14,534	8,463	6,113	6,100	6,251	7,289	4,427	3,664
Dry (24%)	3,103	3,694	5,048	7,023	10,521	9,433	6,359	5,082	4,871	4,713	3,171	3,069
Critical (15%)	2,582	2,741	4,090	5,680	6,582	5,275	4,189	3,102	3,328	2,799	2,552	2,083
Alternative 1 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-989	-1,080	2,841	522	38	964	20	-12	381	-672	-210	-8,159
20%	-656	-2,725	970	1,724	220	212	-28	849	1,192	-1,059	-312	-8,062
30%	-409	-3,037	-303	1,520	1,254	2,293	-28	287	1,799	-1,001	-329	-3,766
40%	-491	-2,222	-479	938	1,411	286	10	769	1,462	-668	-507	-3,368
50%	-156	-1,825	-437	425	263	165	175	567	1,045	-280	-464	-469
60%	326	-997	-589	-404	80	80	-16	697	878	-470	-764	-218
70%	229	-85	-869	-360	270	62	60	420	417	-1,085	-148	-74
80%	26	97	-56	-446	141	163	207	262	657	-938	115	70
90%	86	14	-44	-331	130	74	265	-31	481	-480	50	57
Long Term												
Full Simulation Period ^b	-249	-1,118	65	138	291	306	77	335	799	-682	-251	-2,844
Water Year Types ^c												
Wet (32%)	-564	-1,398	952	544	219	217	-10	108	297	-609	-420	-7,462
Above Normal (16%)	-201	-1,385	-605	450	583	924	111	579	1,244	-572	-418	-3,162
Below Normal (13%)	-332	-1,221	-414	111	800	393	211	978	2,068	-685	-661	-50
Dry (24%)	-86	-1,111	-247	-353	178	79	62	348	717	-957	79	84
Critical (15%)	189	-140	-169	-233	-151	125	131	-51	381	-495	122	64

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
^b Based on the 82-year simulation period.
^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-32-2. Sutter and Steamboat Slough, Monthly Flow

No Action Alternative & Alternative 2

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	5,638	9,919	22,841	30,715	34,265	29,738	21,623	17,660	7,388	9,072	5,798	13,044
20%	5,118	8,100	14,561	24,952	29,584	24,030	14,768	11,502	5,656	8,823	5,613	12,752
30%	4,445	7,825	9,289	17,508	23,047	16,979	10,185	7,102	4,575	8,224	5,352	8,255
40%	3,969	6,762	7,709	10,939	19,729	13,223	8,773	5,574	4,298	7,420	5,249	7,773
50%	3,370	5,910	6,296	9,129	14,750	10,865	6,774	4,994	4,232	6,552	4,790	4,655
60%	2,635	4,713	5,846	7,832	10,867	9,111	5,302	4,528	4,067	6,086	4,392	3,813
70%	2,379	3,412	5,350	6,231	8,435	8,001	4,678	4,374	3,812	5,689	3,357	2,914
80%	2,250	2,743	3,796	5,556	6,943	6,224	4,254	4,044	3,359	4,870	2,687	2,371
90%	1,805	2,331	3,187	4,712	5,838	4,541	3,788	3,408	3,114	3,427	2,335	1,940
Long Term												
Full Simulation Period ^b	3,683	6,361	9,793	13,944	17,426	14,344	9,777	7,750	5,259	6,577	4,367	6,623
Water Year Types^c												
Wet (32%)	4,698	8,688	16,691	23,326	27,078	22,752	16,223	13,578	7,999	7,304	5,292	12,260
Above Normal (16%)	3,238	7,246	10,898	17,822	22,015	19,003	10,799	7,201	4,525	8,363	5,657	7,657
Below Normal (13%)	4,119	6,441	6,401	7,889	13,734	8,070	5,902	5,121	4,183	7,975	5,088	3,714
Dry (24%)	3,189	4,806	5,295	7,376	10,343	9,354	6,297	4,734	4,153	5,670	3,092	2,985
Critical (15%)	2,392	2,881	4,260	5,913	6,733	5,150	4,058	3,153	2,947	3,294	2,430	2,020

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,655	8,981	25,614	31,086	34,292	30,700	21,619	17,642	7,301	8,858	5,700	4,979
20%	4,421	5,559	15,854	26,457	29,791	24,240	14,741	11,882	6,721	8,591	5,460	4,771
30%	3,987	4,855	9,051	19,041	24,281	18,210	10,159	7,348	5,733	8,316	5,118	4,459
40%	3,479	4,405	7,191	11,812	20,933	13,506	8,757	6,313	5,545	7,487	4,917	4,257
50%	3,160	4,087	5,828	9,280	15,030	11,028	6,954	5,489	5,237	6,799	4,586	4,171
60%	2,671	3,707	5,172	7,323	10,944	9,183	5,259	4,982	4,866	6,018	4,198	3,755
70%	2,363	3,356	4,611	5,757	8,923	8,175	4,870	4,670	4,636	4,952	3,458	2,880
80%	2,252	2,811	3,783	5,111	6,950	6,390	4,327	4,406	3,987	4,296	2,763	2,528
90%	1,806	2,339	3,122	4,359	5,955	4,566	4,038	3,499	3,589	2,985	2,378	1,943
Long Term												
Full Simulation Period ^b	3,348	5,199	9,841	14,017	17,709	14,570	9,835	8,077	5,988	6,384	4,261	3,789
Water Year Types^c												
Wet (32%)	4,062	7,287	17,615	23,896	27,272	22,880	16,209	13,724	8,547	7,056	4,904	4,720
Above Normal (16%)	2,990	5,960	10,354	17,956	22,528	19,733	10,885	7,780	5,512	8,240	5,425	4,511
Below Normal (13%)	3,591	5,007	6,025	8,024	14,513	8,425	6,131	5,817	5,182	8,181	5,314	4,079
Dry (24%)	3,075	3,671	5,021	6,996	10,476	9,410	6,344	5,131	4,986	5,414	3,147	2,994
Critical (15%)	2,418	2,576	3,971	5,537	6,755	5,204	4,098	3,146	3,368	2,888	2,500	2,047

Alternative 3 minus No Action Alternative & Alternative 2

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-983	-938	2,773	371	27	962	-4	-18	-87	-214	-98	-8,065
20%	-697	-2,541	1,293	1,505	207	210	-27	380	1,064	-233	-153	-7,981
30%	-458	-2,970	-238	1,533	1,234	1,231	-26	245	1,158	92	-234	-3,796
40%	-490	-2,358	-518	872	1,204	283	-17	739	1,247	67	-332	-3,517
50%	-209	-1,823	-468	151	280	163	180	494	1,005	248	-204	-485
60%	35	-1,007	-674	-509	77	72	-44	454	799	-67	-194	-59
70%	-16	-56	-739	-473	488	174	192	296	824	-737	101	-33
80%	1	68	-13	-445	7	166	73	363	628	-573	75	157
90%	1	8	-65	-353	116	26	250	91	474	-442	43	3
Long Term												
Full Simulation Period ^b	-336	-1,162	48	72	283	226	57	327	729	-192	-106	-2,834
Water Year Types^c												
Wet (32%)	-635	-1,401	924	570	193	128	-14	146	547	-248	-389	-7,540
Above Normal (16%)	-248	-1,286	-543	134	513	730	87	579	987	-122	-233	-3,146
Below Normal (13%)	-527	-1,434	-376	135	779	355	229	695	999	206	226	365
Dry (24%)	-114	-1,134	-274	-380	133	56	47	397	833	-257	55	9
Critical (15%)	26	-305	-288	-376	22	54	40	-8	421	-406	70	28

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-32-3. Sutter and Steamboat Slough, Monthly Flow

No Action Alternative & Alternative 2

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	5,638	9,919	22,841	30,715	34,265	29,738	21,623	17,660	7,388	9,072	5,798	13,044
20%	5,118	8,100	14,561	24,952	29,584	24,030	14,768	11,502	5,656	8,823	5,613	12,752
30%	4,445	7,825	9,289	17,508	23,047	16,979	10,185	7,102	4,575	8,224	5,352	8,255
40%	3,969	6,762	7,709	10,939	19,729	13,223	8,773	5,574	4,298	7,420	5,249	7,773
50%	3,370	5,910	6,296	9,129	14,750	10,865	6,774	4,994	4,232	6,552	4,790	4,655
60%	2,635	4,713	5,846	7,832	10,867	9,111	5,302	4,528	4,067	6,086	4,392	3,813
70%	2,379	3,412	5,350	6,231	8,435	8,001	4,678	4,374	3,812	5,689	3,357	2,914
80%	2,250	2,743	3,796	5,556	6,943	6,224	4,254	4,044	3,359	4,870	2,687	2,371
90%	1,805	2,331	3,187	4,712	5,838	4,541	3,788	3,408	3,114	3,427	2,335	1,940
Long Term												
Full Simulation Period ^b	3,683	6,361	9,793	13,944	17,426	14,344	9,777	7,750	5,259	6,577	4,367	6,623
Water Year Types^c												
Wet (32%)	4,698	8,688	16,691	23,326	27,078	22,752	16,223	13,578	7,999	7,304	5,292	12,260
Above Normal (16%)	3,238	7,246	10,898	17,822	22,015	19,003	10,799	7,201	4,525	8,363	5,657	7,657
Below Normal (13%)	4,119	6,441	6,401	7,889	13,734	8,070	5,902	5,121	4,183	7,975	5,088	3,714
Dry (24%)	3,189	4,806	5,295	7,376	10,343	9,354	6,297	4,734	4,153	5,670	3,092	2,985
Critical (15%)	2,392	2,881	4,260	5,913	6,733	5,150	4,058	3,153	2,947	3,294	2,430	2,020

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	5,626	9,905	22,792	30,588	34,257	29,735	21,624	17,663	7,422	9,036	5,798	13,038
20%	4,926	8,064	14,561	24,919	29,567	24,035	14,767	11,460	5,622	8,816	5,637	12,659
30%	4,384	7,838	9,295	17,508	23,186	17,024	10,189	7,100	4,590	8,434	5,396	8,258
40%	3,981	6,857	7,720	10,911	19,737	13,224	8,781	5,314	4,324	7,483	5,249	7,767
50%	3,389	5,901	6,295	9,140	14,814	10,820	6,789	4,834	4,212	6,792	5,044	4,773
60%	2,635	4,723	5,839	7,807	10,869	9,110	5,156	4,448	4,061	6,246	4,650	4,065
70%	2,416	3,424	5,412	6,225	8,436	7,959	4,761	3,942	3,881	5,959	3,524	2,956
80%	2,249	2,744	3,795	5,556	6,943	6,223	4,081	3,599	3,269	5,075	2,826	2,449
90%	1,805	2,334	3,173	4,689	5,828	4,536	3,731	2,973	3,110	3,529	2,566	2,075
Long Term												
Full Simulation Period ^b	3,669	6,373	9,787	13,951	17,428	14,342	9,745	7,565	5,251	6,703	4,471	6,620
Water Year Types^c												
Wet (32%)	4,660	8,749	16,681	23,370	27,094	22,759	16,223	13,576	7,984	7,406	5,330	12,175
Above Normal (16%)	3,288	7,225	10,908	17,816	22,010	18,979	10,801	7,113	4,505	8,386	5,631	7,617
Below Normal (13%)	4,077	6,437	6,377	7,873	13,732	8,078	5,925	4,919	4,113	8,055	5,154	3,851
Dry (24%)	3,166	4,793	5,295	7,373	10,362	9,351	6,264	4,299	4,171	5,939	3,312	3,028
Critical (15%)	2,401	2,879	4,250	5,893	6,689	5,141	3,866	2,902	2,978	3,393	2,656	2,030

Alternative 5 minus No Action Alternative & Alternative 2

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-12	-15	-50	-127	-8	-3	1	3	34	-36	1	-6
20%	-192	-36	0	-34	-16	5	-1	-43	-34	-8	24	-93
30%	-61	13	6	0	139	44	3	-2	15	210	44	3
40%	12	95	11	-29	8	0	8	-260	27	62	-1	-6
50%	19	-9	-1	11	64	-45	15	-161	-20	240	254	118
60%	0	10	-7	-25	2	-1	-147	-80	-6	161	258	252
70%	37	11	62	-5	1	-41	82	-432	69	270	167	42
80%	-2	1	-1	0	0	-2	-174	-445	-91	205	139	78
90%	0	3	-14	-23	-11	-5	-56	-436	-4	102	231	135
Long Term												
Full Simulation Period ^b	-14	12	-6	7	2	-2	-33	-185	-8	127	104	-3
Water Year Types^c												
Wet (32%)	-37	61	-10	44	16	7	0	-2	-15	102	38	-84
Above Normal (16%)	50	-21	10	-6	-5	-24	2	-88	-20	23	-26	-40
Below Normal (13%)	-42	-5	-24	-16	-2	8	23	-202	-70	80	66	137
Dry (24%)	-23	-12	1	-3	19	-2	-33	-436	18	268	220	42
Critical (15%)	9	-2	-10	-20	-44	-9	-192	-251	31	99	226	10

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-32-4. Sutter and Steamboat Slough, Monthly Flow

Second Basis of Comparison												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	4,649	8,840	25,683	31,237	34,303	30,702	21,643	17,648	7,769	8,400	5,588	4,885
20%	4,462	5,375	15,531	26,676	29,803	24,242	14,740	12,352	6,848	7,765	5,301	4,690
30%	4,036	4,788	8,986	19,028	24,301	19,273	10,157	7,389	6,374	7,223	5,023	4,489
40%	3,478	4,540	7,230	11,878	21,140	13,509	8,783	6,343	5,760	6,752	4,743	4,405
50%	3,213	4,085	5,858	9,554	15,013	11,030	6,949	5,561	5,277	6,271	4,326	4,186
60%	2,961	3,716	5,257	7,428	10,947	9,190	5,286	5,226	4,945	5,615	3,628	3,595
70%	2,608	3,328	4,481	5,870	8,705	8,062	4,739	4,793	4,229	4,603	3,209	2,840
80%	2,277	2,840	3,740	5,110	7,084	6,387	4,461	4,306	4,016	3,932	2,803	2,441
90%	1,891	2,345	3,143	4,381	5,968	4,614	4,053	3,378	3,595	2,947	2,385	1,997
Long Term												
Full Simulation Period ^b	3,435	5,243	9,859	14,083	17,717	14,650	9,854	8,085	6,059	5,895	4,116	3,779
Water Year Types ^c												
Wet (32%)	4,134	7,289	17,643	23,870	27,298	22,969	16,213	13,686	8,296	6,695	4,872	4,797
Above Normal (16%)	3,037	5,861	10,293	18,272	22,598	19,927	10,909	7,780	5,769	7,790	5,239	4,495
Below Normal (13%)	3,787	5,220	5,987	8,000	14,534	8,463	6,113	6,100	6,251	7,289	4,427	3,664
Dry (24%)	3,103	3,694	5,048	7,023	10,521	9,433	6,359	5,082	4,871	4,713	3,171	3,069
Critical (15%)	2,582	2,741	4,090	5,680	6,582	5,275	4,189	3,102	3,328	2,799	2,552	2,083

No Action Alternative & Alternative 2												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	5,638	9,919	22,841	30,715	34,265	29,738	21,623	17,660	7,388	9,072	5,798	13,044
20%	5,118	8,100	14,561	24,952	29,584	24,030	14,768	11,502	5,656	8,823	5,613	12,752
30%	4,445	7,825	9,289	17,508	23,047	16,979	10,185	7,102	4,575	8,224	5,352	8,255
40%	3,969	6,762	7,709	10,939	19,729	13,223	8,773	5,574	4,298	7,424	5,249	7,773
50%	3,370	5,910	6,296	9,129	14,750	10,865	6,774	4,994	4,232	6,552	4,790	4,655
60%	2,635	4,713	5,846	7,832	10,867	9,111	5,302	4,528	4,067	6,086	4,392	3,813
70%	2,379	3,412	5,350	6,231	8,435	8,001	4,678	4,374	3,812	5,689	3,357	2,914
80%	2,250	2,743	3,796	5,556	6,943	6,224	4,254	4,044	3,359	4,870	2,687	2,371
90%	1,805	2,331	3,187	4,712	5,838	4,541	3,788	3,408	3,114	3,427	2,335	1,940
Long Term												
Full Simulation Period ^b	3,683	6,361	9,793	13,944	17,426	14,344	9,777	7,750	5,259	6,577	4,367	6,623
Water Year Types ^c												
Wet (32%)	4,698	8,688	16,691	23,326	27,078	22,752	16,223	13,578	7,999	7,304	5,292	12,260
Above Normal (16%)	3,238	7,246	10,898	17,822	22,015	19,003	10,799	7,201	4,525	8,363	5,657	7,657
Below Normal (13%)	4,119	6,441	6,401	7,889	13,734	8,070	5,902	5,121	4,183	7,975	5,088	3,714
Dry (24%)	3,189	4,806	5,295	7,376	10,343	9,354	6,297	4,734	4,153	5,670	3,092	2,985
Critical (15%)	2,392	2,881	4,260	5,913	6,733	5,150	4,058	3,153	2,947	3,294	2,430	2,020

No Action Alternative & Alternative 2 minus Second Basis of Comparison												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	989	1,080	-2,841	-522	-38	-964	-20	12	-381	672	210	8,159
20%	656	2,725	-970	-1,724	-220	-212	28	-849	-1,192	1,059	312	8,062
30%	409	3,037	-1,520	-1,254	-2,293	-2,293	28	-287	-1,799	1,001	329	3,766
40%	491	2,222	479	-938	-1,411	-286	-10	-769	-1,462	668	507	3,368
50%	156	1,825	437	-425	-263	-165	-175	-567	-1,045	280	464	469
60%	-326	997	589	404	-80	-80	16	-697	-878	470	764	218
70%	-229	85	869	360	-270	-62	-60	-420	-417	1,085	148	74
80%	-26	-97	56	446	-141	-163	-207	-262	-657	938	-115	-70
90%	-86	-14	44	331	-130	-74	-265	31	-481	480	-50	-57
Long Term												
Full Simulation Period ^b	249	1,118	-65	-138	-291	-306	-77	-335	-799	682	251	2,844
Water Year Types ^c												
Wet (32%)	564	1,398	-952	-544	-219	-217	10	-108	-297	609	420	7,462
Above Normal (16%)	201	1,385	605	-450	-583	-924	-111	-579	-1,244	572	418	3,162
Below Normal (13%)	332	1,221	414	-111	-800	-393	-211	-978	-2,068	685	661	50
Dry (24%)	86	1,111	247	353	-178	-79	-62	-348	-717	957	-79	-84
Critical (15%)	-189	140	169	233	151	-125	-131	51	-381	495	-122	-64

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
^b Based on the 82-year simulation period.
^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-32-5. Sutter and Steamboat Slough, Monthly Flow

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	4,649	8,840	25,683	31,237	34,303	30,702	21,643	17,648	7,769	8,400	5,588	4,885
20%	4,462	5,375	15,531	26,676	29,803	24,242	14,740	12,352	6,848	7,765	5,301	4,690
30%	4,036	4,788	8,986	19,028	24,301	19,273	10,157	7,389	6,374	7,223	5,023	4,489
40%	3,478	4,540	7,230	11,878	21,140	13,509	8,783	6,343	5,760	6,752	4,743	4,405
50%	3,213	4,085	5,858	9,554	15,013	11,030	6,949	5,561	5,277	6,271	4,326	4,186
60%	2,961	3,716	5,257	7,428	10,947	9,190	5,286	5,226	4,945	5,615	3,628	3,595
70%	2,608	3,328	4,481	5,870	8,705	8,062	4,739	4,793	4,229	4,603	3,209	2,840
80%	2,277	2,840	3,740	5,110	7,084	6,387	4,461	4,306	4,016	3,932	2,803	2,441
90%	1,891	2,345	3,143	4,381	5,968	4,614	4,053	3,378	3,595	2,947	2,385	1,997
Long Term												
Full Simulation Period ^b	3,435	5,243	9,859	14,083	17,717	14,650	9,854	8,085	6,059	5,895	4,116	3,779
Water Year Types ^c												
Wet (32%)	4,134	7,289	17,643	23,870	27,298	22,969	16,213	13,686	8,296	6,695	4,872	4,797
Above Normal (16%)	3,037	5,861	10,293	18,272	22,598	19,927	10,909	7,780	5,769	7,790	5,239	4,495
Below Normal (13%)	3,787	5,220	5,987	8,000	14,534	8,463	6,113	6,100	6,251	7,289	4,427	3,664
Dry (24%)	3,103	3,694	5,048	7,023	10,521	9,433	6,359	5,082	4,871	4,713	3,171	3,069
Critical (15%)	2,582	2,741	4,090	5,680	6,582	5,275	4,189	3,102	3,328	2,799	2,552	2,083

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	4,655	8,981	25,614	31,086	34,292	30,700	21,619	17,642	7,301	8,858	5,700	4,979
20%	4,421	5,559	15,854	26,457	29,791	24,240	14,741	11,882	6,721	8,591	5,460	4,771
30%	3,987	4,855	9,051	19,041	24,281	18,210	10,159	7,348	5,733	8,316	5,118	4,459
40%	3,479	4,405	7,191	11,812	20,933	13,506	8,757	6,313	5,545	7,487	4,917	4,257
50%	3,160	4,087	5,828	9,280	15,030	11,028	6,954	5,489	5,237	6,799	4,586	4,171
60%	2,671	3,707	5,172	7,323	10,944	9,183	5,259	4,982	4,866	6,018	4,198	3,755
70%	2,363	3,356	4,611	5,757	8,923	8,175	4,870	4,670	4,636	4,952	3,458	2,880
80%	2,252	2,811	3,783	5,111	6,950	6,390	4,327	4,406	3,987	4,296	2,763	2,528
90%	1,806	2,339	3,122	4,359	5,955	4,566	4,038	3,499	3,589	2,985	2,378	1,943
Long Term												
Full Simulation Period ^b	3,348	5,199	9,841	14,017	17,709	14,570	9,835	8,077	5,988	6,384	4,261	3,789
Water Year Types ^c												
Wet (32%)	4,062	7,287	17,615	23,896	27,272	22,880	16,209	13,724	8,547	7,056	4,904	4,720
Above Normal (16%)	2,990	5,960	10,354	17,956	22,528	19,733	10,885	7,780	5,512	8,240	5,425	4,511
Below Normal (13%)	3,591	5,007	6,025	8,024	14,513	8,425	6,131	5,817	5,182	8,181	5,314	4,079
Dry (24%)	3,075	3,671	5,021	6,996	10,476	9,410	6,344	5,131	4,986	5,414	3,147	2,994
Critical (15%)	2,418	2,576	3,971	5,537	6,755	5,204	4,098	3,146	3,368	2,888	2,500	2,047

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	6	141	-69	-151	-11	-3	-24	-6	-469	458	112	94
20%	-41	184	324	-219	-12	-3	1	-470	-128	826	159	80
30%	-49	67	65	13	-20	-1,063	2	-42	-641	1,093	95	-30
40%	1	-136	-39	-66	-207	-3	-26	-31	-215	735	175	-149
50%	-53	3	-30	-274	18	-2	5	-72	-40	528	260	-16
60%	-290	-9	-85	-105	-3	-8	-28	-244	-79	403	570	159
70%	-245	28	129	-113	218	112	131	-124	407	348	248	40
80%	-25	-29	43	1	-134	3	-133	101	-29	365	-40	87
90%	-85	-6	-21	-21	-13	-48	-15	122	-7	37	-7	-55
Long Term												
Full Simulation Period ^b	-87	-43	-18	-66	-8	-80	-20	-8	-71	489	145	10
Water Year Types ^c												
Wet (32%)	-71	-2	-28	26	-26	-89	-4	38	251	361	31	-78
Above Normal (16%)	-48	99	62	-316	-69	-194	-24	0	-257	450	185	16
Below Normal (13%)	-195	-213	38	24	-21	-38	18	-283	-1,070	892	887	415
Dry (24%)	-28	-23	-27	-26	-45	-23	-15	49	116	701	-24	-75
Critical (15%)	-164	-165	-119	-143	172	-71	-91	43	40	88	-52	-36

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-32-6. Sutter and Steamboat Slough, Monthly Flow

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	4,649	8,840	25,683	31,237	34,303	30,702	21,643	17,648	7,769	8,400	5,588	4,885
20%	4,462	5,375	15,531	26,676	29,803	24,242	14,740	12,352	6,848	7,765	5,301	4,690
30%	4,036	4,788	8,986	19,028	24,301	19,273	10,157	7,389	6,374	7,223	5,023	4,489
40%	3,478	4,540	7,230	11,878	21,140	13,509	8,783	6,343	5,760	6,752	4,743	4,405
50%	3,213	4,085	5,858	9,554	15,013	11,030	6,949	5,561	5,277	6,271	4,326	4,186
60%	2,961	3,716	5,257	7,428	10,947	9,190	5,286	5,226	4,945	5,615	3,628	3,595
70%	2,608	3,328	4,481	5,870	8,705	8,062	4,739	4,793	4,229	4,603	3,209	2,840
80%	2,277	2,840	3,740	5,110	7,084	6,387	4,461	4,306	4,016	3,932	2,803	2,441
90%	1,891	2,345	3,143	4,381	5,968	4,614	4,053	3,378	3,595	2,947	2,385	1,997
Long Term												
Full Simulation Period ^b	3,435	5,243	9,859	14,083	17,717	14,650	9,854	8,085	6,059	5,895	4,116	3,779
Water Year Types ^c												
Wet (32%)	4,134	7,289	17,643	23,870	27,298	22,969	16,213	13,686	8,296	6,695	4,872	4,797
Above Normal (16%)	3,037	5,861	10,293	18,272	22,598	19,927	10,909	7,780	5,769	7,790	5,239	4,495
Below Normal (13%)	3,787	5,220	5,987	8,000	14,534	8,463	6,113	6,100	6,251	7,289	4,427	3,664
Dry (24%)	3,103	3,694	5,048	7,023	10,521	9,433	6,359	5,082	4,871	4,713	3,171	3,069
Critical (15%)	2,582	2,741	4,090	5,680	6,582	5,275	4,189	3,102	3,328	2,799	2,552	2,083

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 5												
Probability of Exceedance ^a												
10%	5,626	9,905	22,792	30,588	34,257	29,735	21,624	17,663	7,422	9,036	5,798	13,038
20%	4,926	8,064	14,561	24,919	29,567	24,035	14,767	11,460	5,622	8,816	5,637	12,659
30%	4,384	7,838	9,295	17,508	23,186	17,024	10,189	7,100	4,590	8,434	5,396	8,258
40%	3,981	6,857	7,720	10,911	19,737	13,224	8,781	5,314	4,324	7,483	5,249	7,737
50%	3,389	5,901	6,295	9,140	14,814	10,820	6,789	4,834	4,212	6,792	5,044	4,773
60%	2,635	4,723	5,839	7,807	10,869	9,110	5,156	4,448	4,061	6,246	4,650	4,065
70%	2,416	3,424	5,412	6,225	8,436	7,959	4,761	3,942	3,881	5,959	3,524	2,956
80%	2,249	2,744	3,795	5,556	6,943	6,223	4,081	3,599	3,269	5,075	2,826	2,449
90%	1,805	2,334	3,173	4,689	5,828	4,536	3,731	2,973	3,110	3,529	2,566	2,075
Long Term												
Full Simulation Period ^b	3,669	6,373	9,787	13,951	17,428	14,342	9,745	7,565	5,251	6,703	4,471	6,620
Water Year Types ^c												
Wet (32%)	4,660	8,749	16,681	23,370	27,094	22,759	16,223	13,576	7,984	7,406	5,330	12,175
Above Normal (16%)	3,288	7,225	10,908	17,816	22,010	18,979	10,801	7,113	4,505	8,386	5,631	7,617
Below Normal (13%)	4,077	6,437	6,377	7,873	13,732	8,078	5,925	4,919	4,113	8,055	5,154	3,851
Dry (24%)	3,166	4,793	5,295	7,373	10,362	9,351	6,264	4,299	4,171	5,939	3,312	3,028
Critical (15%)	2,401	2,879	4,250	5,893	6,689	5,141	3,866	2,902	2,978	3,393	2,656	2,030

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 5 minus Second Basis of Comparison												
Probability of Exceedance ^a												
10%	977	1,065	-2,891	-649	-46	-967	-19	15	-348	636	211	8,153
20%	464	2,689	-970	-1,757	-236	-207	27	-892	-1,227	1,051	337	7,968
30%	348	3,050	309	-1,520	-1,115	-2,249	32	-289	-1,784	1,211	373	3,770
40%	502	2,317	490	-967	-1,403	-286	-2	-1,030	-1,436	730	506	3,361
50%	176	1,816	437	-414	-198	-210	-160	-727	-1,065	521	717	587
60%	-326	1,007	582	380	-78	-81	-131	-777	-884	631	1,023	470
70%	-192	96	930	355	-269	-103	22	-851	-348	1,355	314	116
80%	-28	-96	55	446	-141	-164	-380	-707	-747	1,143	23	8
90%	-86	-10	30	308	-140	-78	-322	-405	-485	582	181	78
Long Term												
Full Simulation Period ^b	235	1,131	-72	-131	-289	-308	-110	-519	-808	808	354	2,841
Water Year Types ^c												
Wet (32%)	527	1,459	-962	-500	-204	-210	10	-110	-312	711	458	7,378
Above Normal (16%)	250	1,364	616	-456	-588	-947	-108	-667	-1,264	595	392	3,122
Below Normal (13%)	290	1,217	390	-127	-802	-385	-188	-1,180	-2,138	766	727	187
Dry (24%)	63	1,099	247	350	-159	-81	-95	-783	-700	1,226	141	-42
Critical (15%)	-180	138	159	213	107	-134	-323	-201	-350	594	104	-54

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.


c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

This page left blank intentionally.

1 **C.33. Qwest Flow**


Figure C-33-1. Qwest, Long-Term* Average Flow

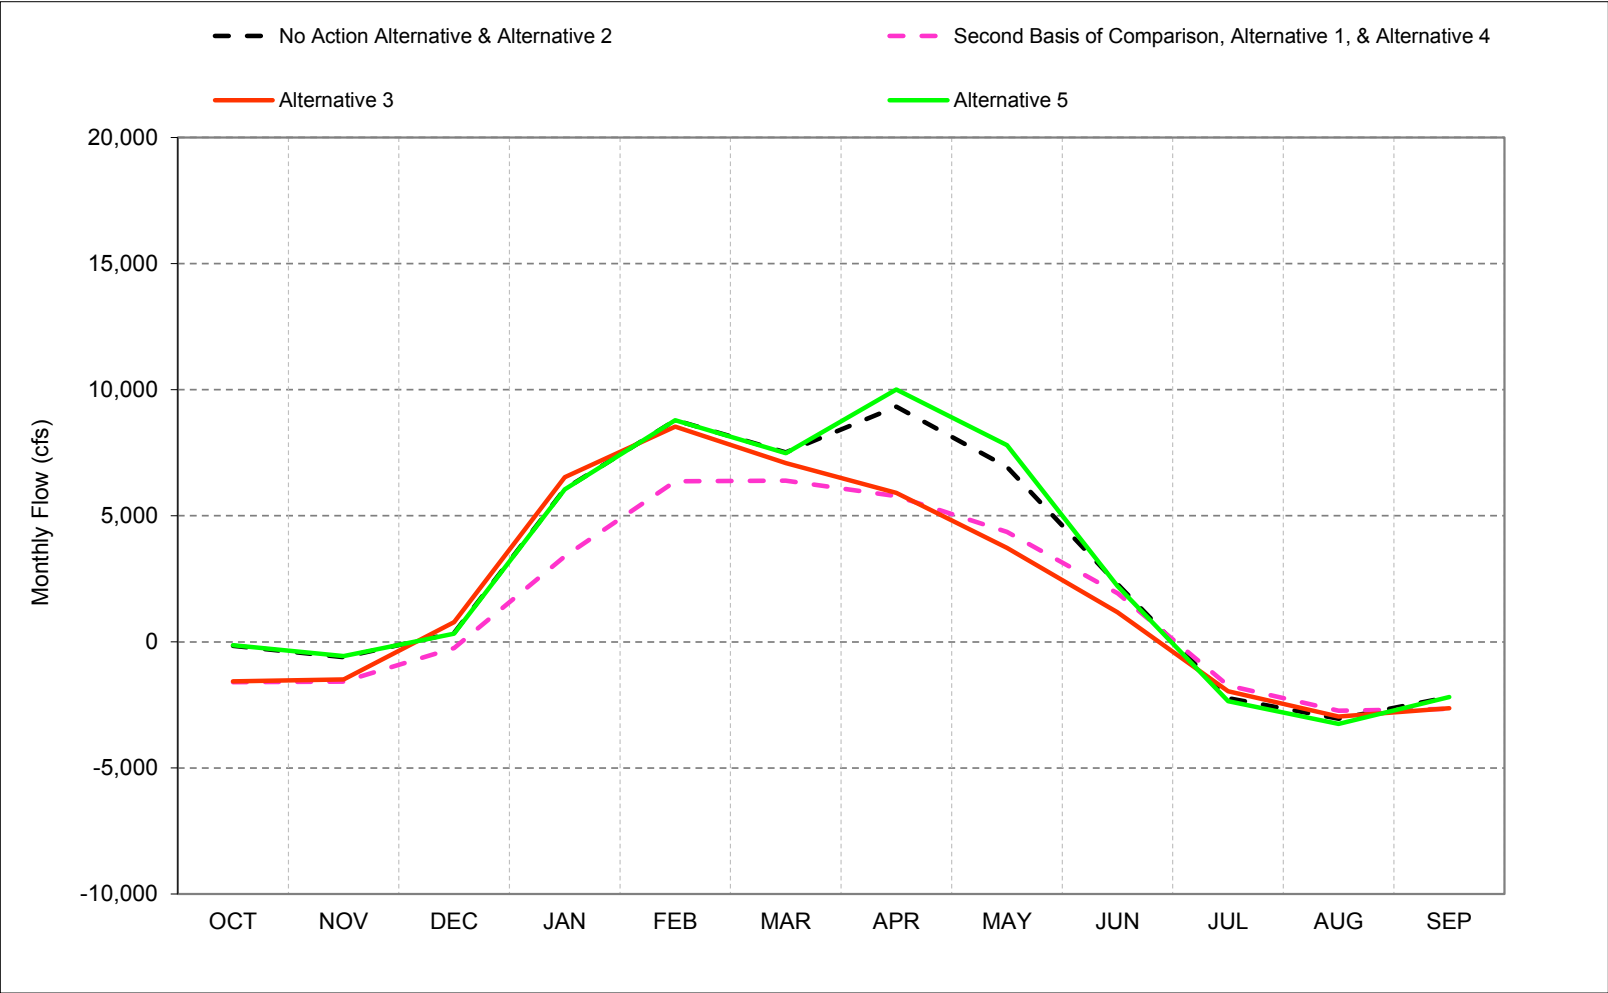

*Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-33-2. Qwest, Wet Year* Long-Term** Average Flow

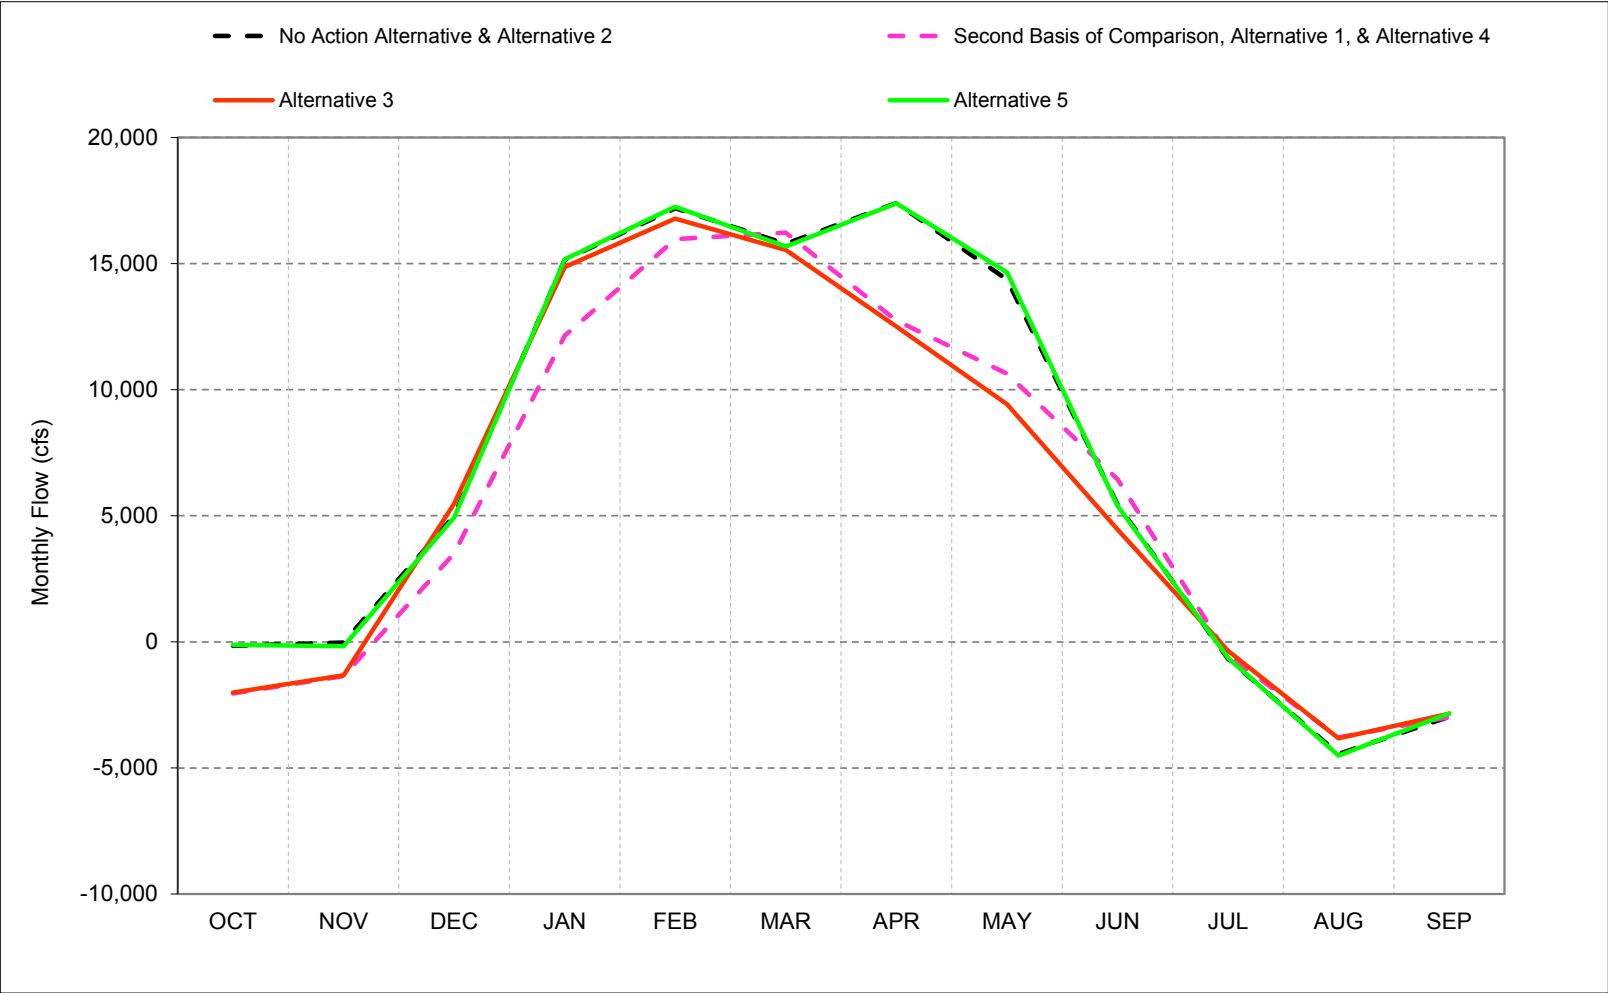


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-33-3. Qwest, Above Normal Year* Long-Term** Average Flow

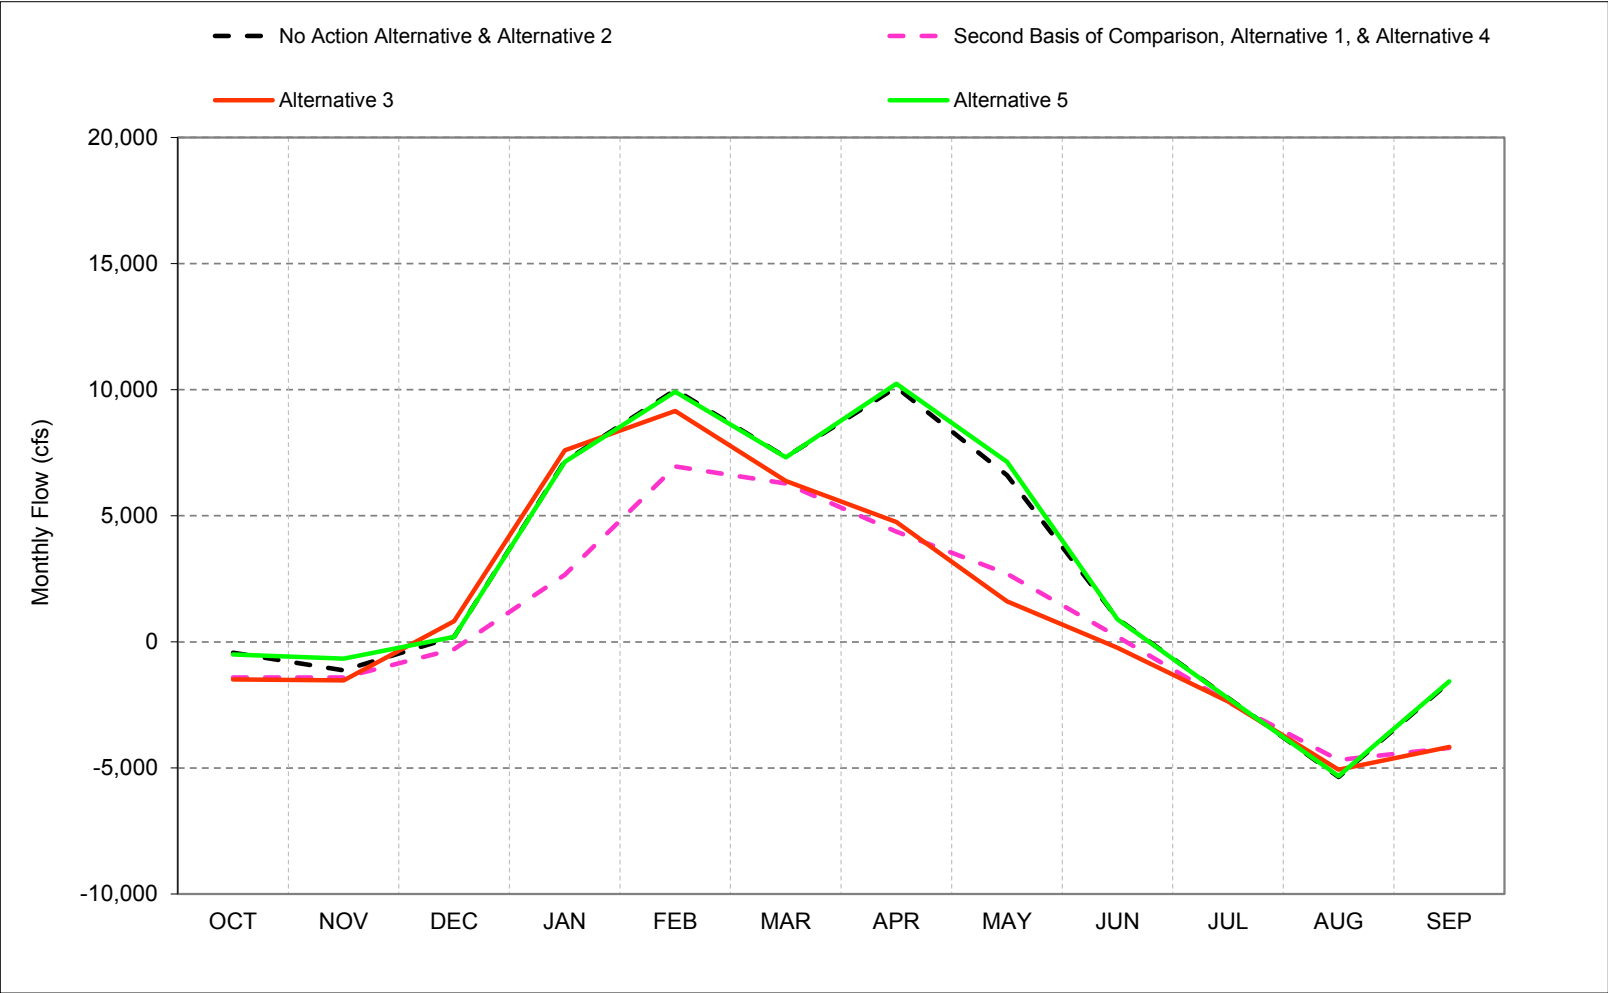


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-33-4. Qwest, Below Normal Year* Long-Term** Average Flow

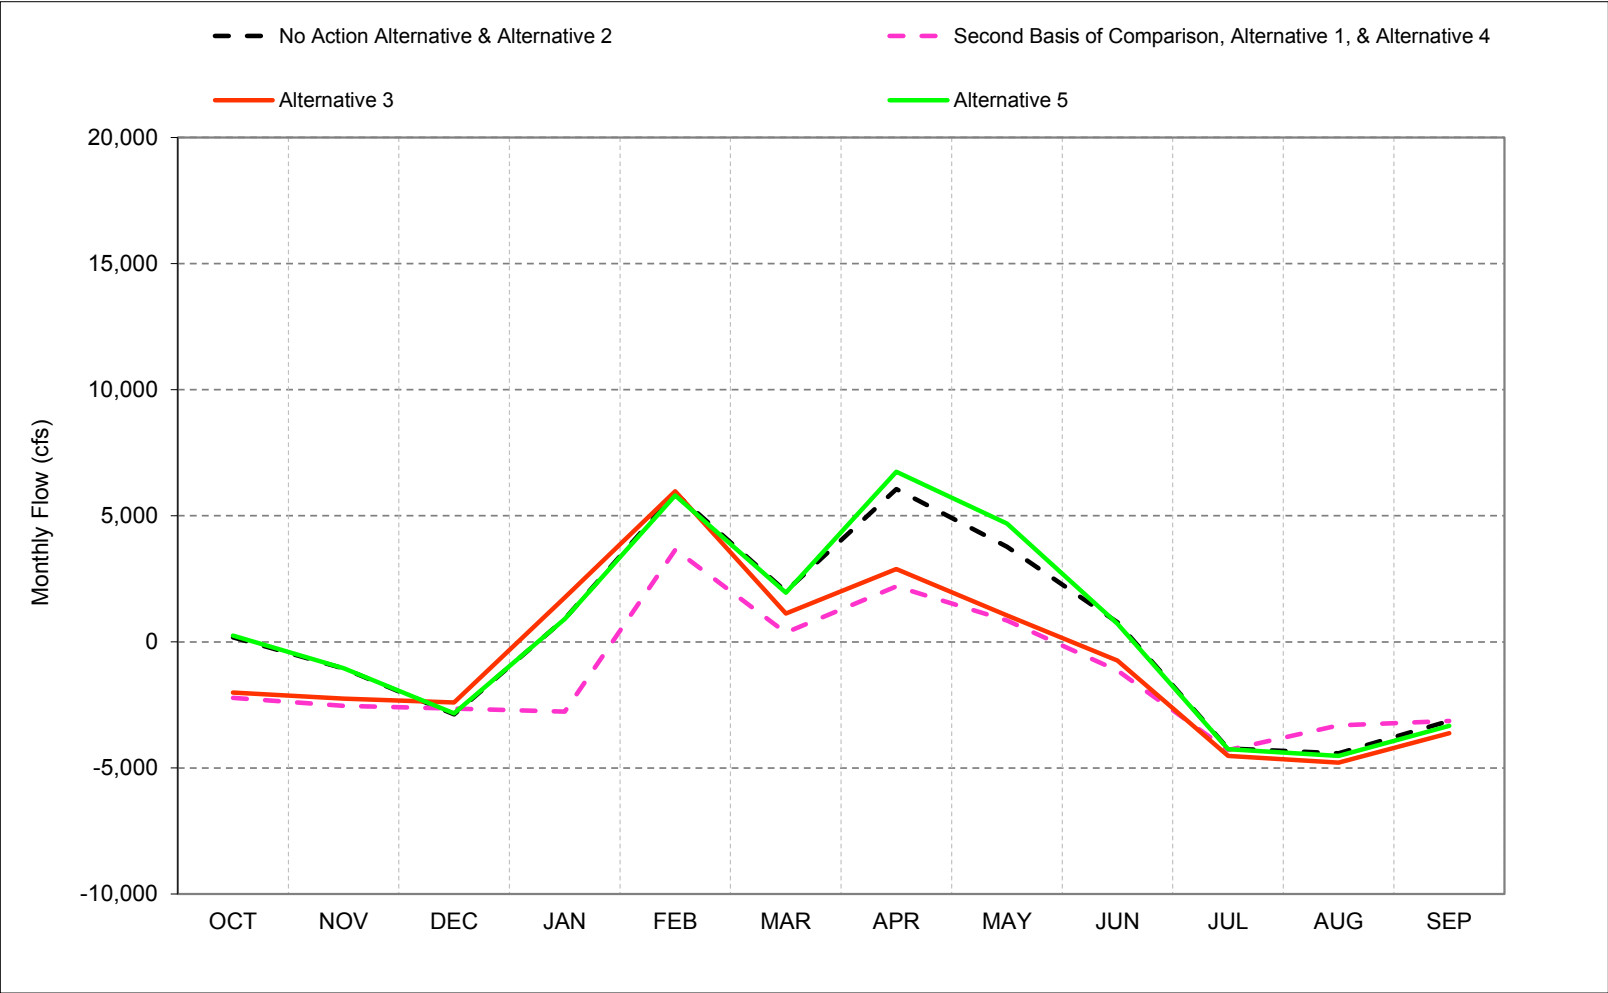


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-33-5. Qwest, Dry Year* Long-Term** Average Flow

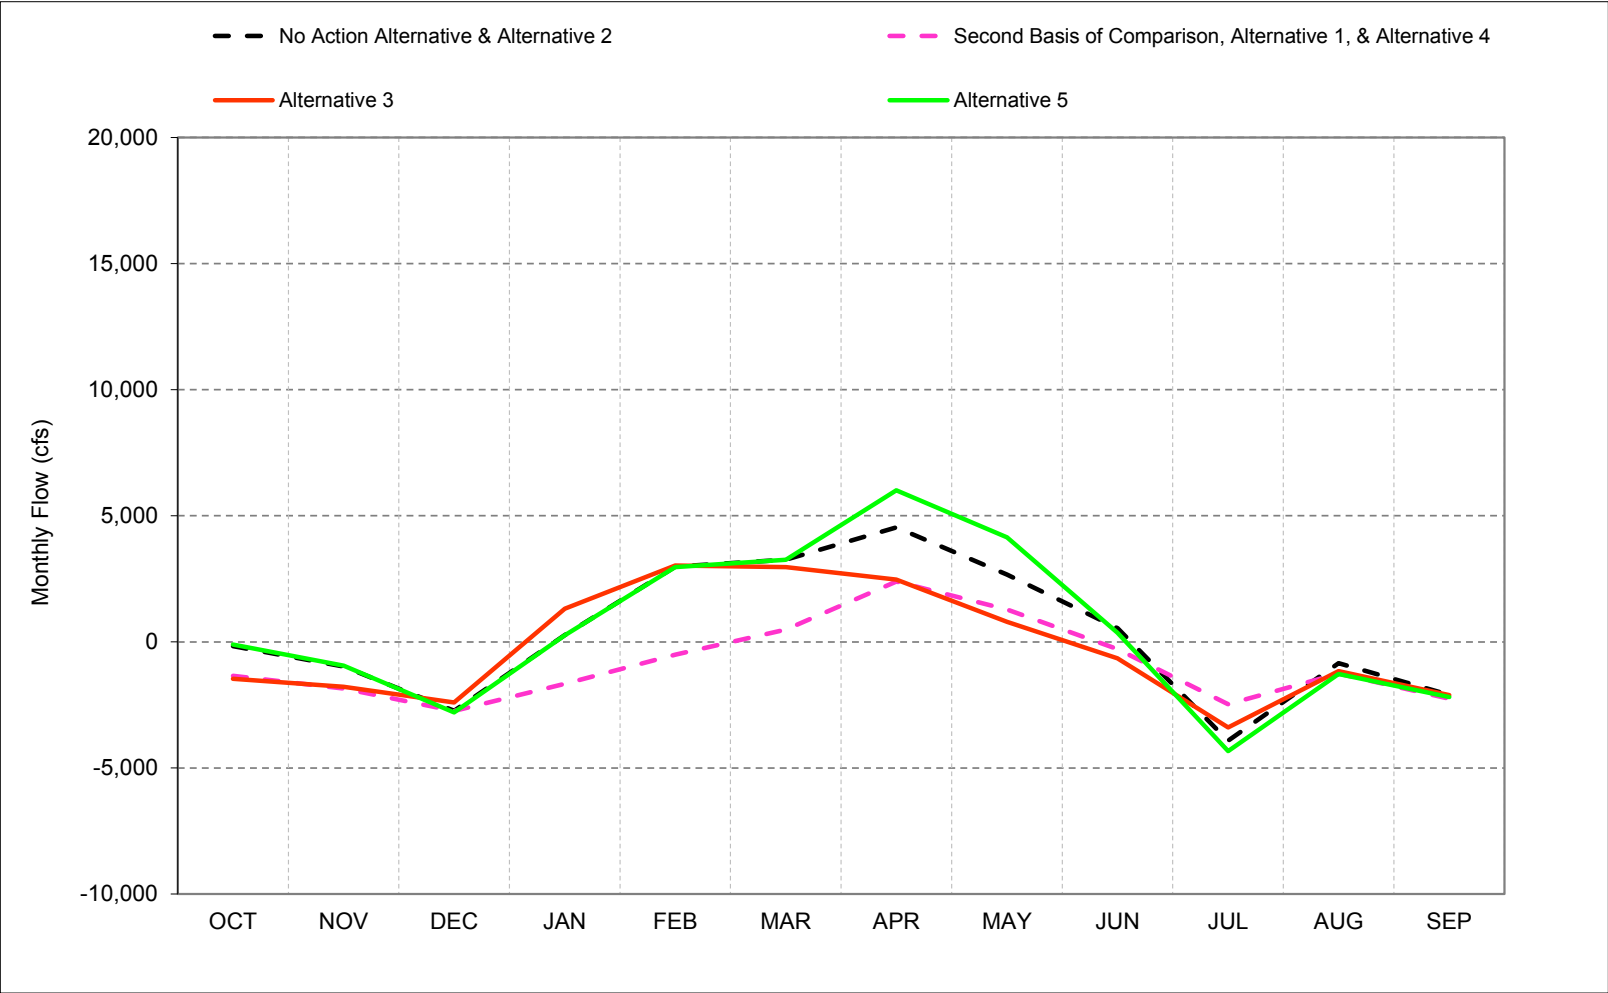


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-33-6. Qwest, Critical Year* Long-Term** Average Flow

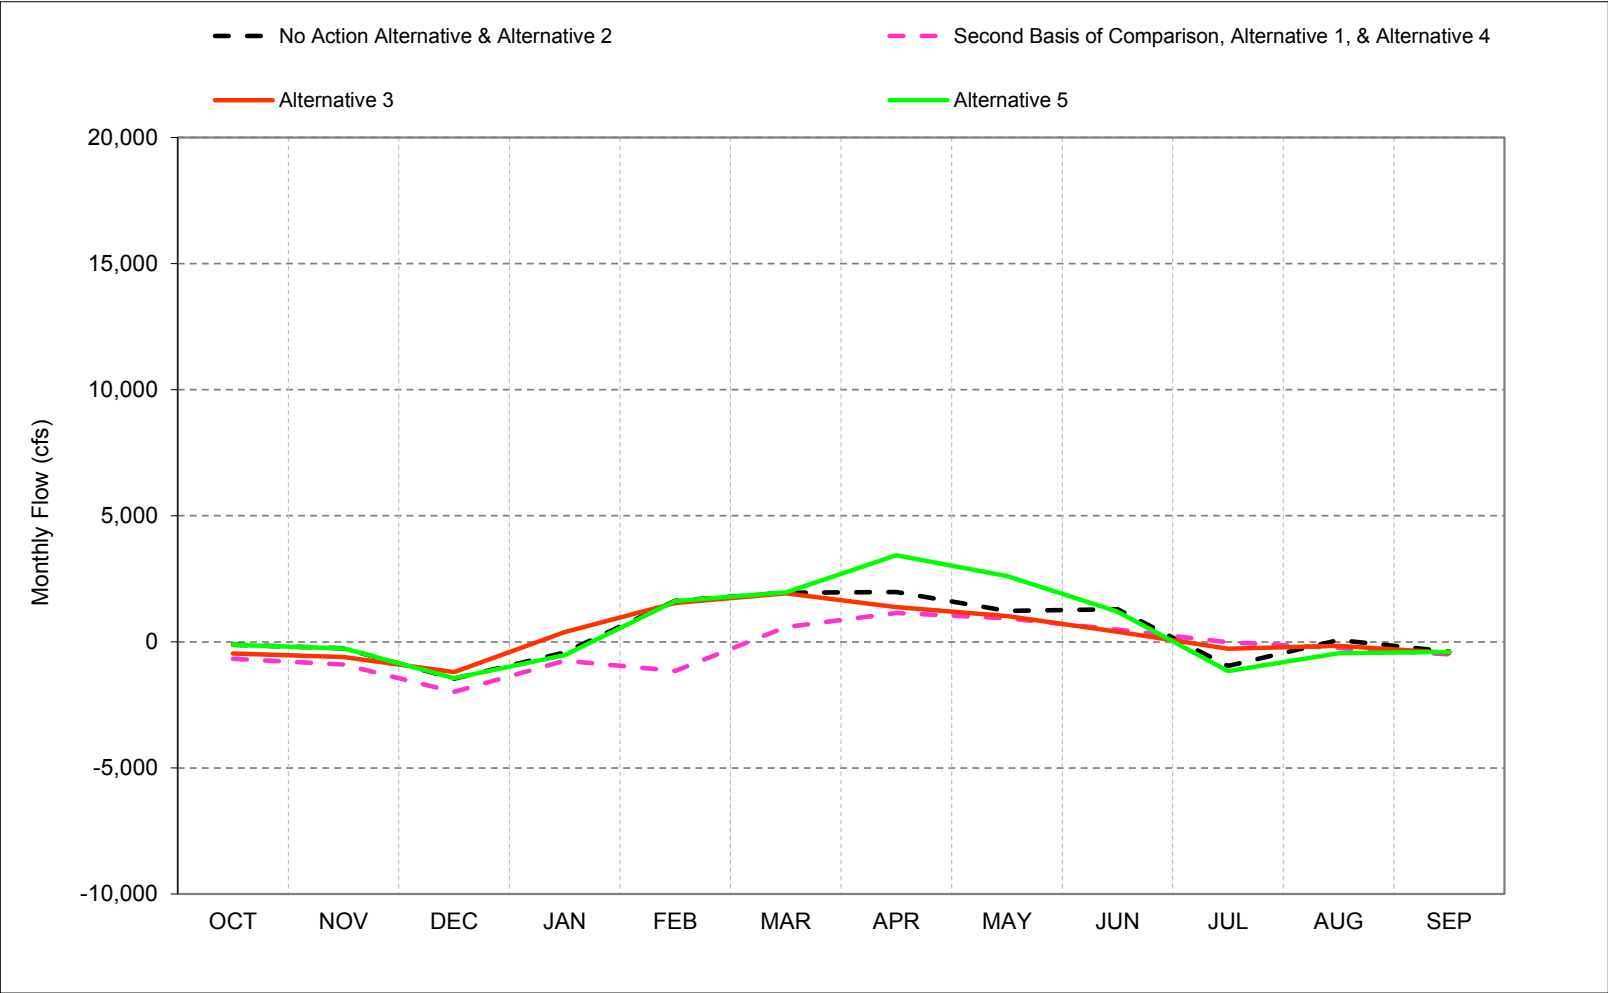

*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-33-1. Qwest, Monthly Flow

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,190	939	7,381	16,329	20,138	16,951	21,018	17,565	6,736	440	871	120
20%	515	53	1,563	11,264	12,704	10,469	13,927	9,636	3,197	-437	-453	-734
30%	215	-36	-367	5,662	10,982	7,517	10,386	6,993	1,869	-1,594	-1,445	-1,120
40%	59	-439	-908	3,520	7,240	5,489	9,345	6,123	1,385	-2,172	-2,923	-1,931
50%	13	-688	-1,266	2,051	4,895	3,149	7,690	5,136	1,021	-2,566	-3,852	-2,445
60%	-277	-1,356	-1,870	926	3,228	2,565	6,087	2,939	740	-3,117	-4,635	-3,011
70%	-498	-1,752	-3,347	-388	1,998	1,798	3,568	2,183	544	-3,831	-4,922	-3,732
80%	-771	-2,186	-5,079	-1,042	1,138	1,341	2,090	1,276	97	-4,457	-5,315	-4,050
90%	-1,577	-3,655	-5,613	-1,317	-525	826	1,649	929	-75	-4,771	-5,533	-4,414
Long Term												
Full Simulation Period ^b	-152	-604	354	6,065	8,790	7,514	9,325	6,938	2,291	-2,226	-3,046	-2,189
Water Year Types^c												
Wet (32%)	-159	-25	5,007	15,152	17,194	15,778	17,396	14,363	5,435	-668	-4,441	-2,977
Above Normal (16%)	-434	-1,125	199	7,163	9,988	7,324	10,091	6,608	909	-2,220	-5,358	-1,608
Below Normal (13%)	185	-1,055	-2,871	908	5,888	2,004	6,057	3,774	773	-4,223	-4,418	-3,135
Dry (24%)	-166	-978	-2,732	266	2,980	3,262	4,539	2,664	538	-3,920	-846	-2,104
Critical (15%)	-118	-258	-1,458	-420	1,627	1,952	1,977	1,228	1,289	-954	74	-384

Alternative 1

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	526	63	3,807	14,561	22,874	19,881	17,707	11,934	6,962	589	574	51
20%	52	-329	-373	5,175	11,903	12,002	9,173	5,150	3,364	-449	-914	-893
30%	-460	-1,268	-1,373	2,351	7,291	6,402	5,119	3,265	1,714	-1,165	-1,709	-1,906
40%	-1,099	-1,835	-2,345	434	3,614	3,627	3,040	2,343	986	-1,555	-2,018	-2,562
50%	-1,755	-2,203	-2,771	-770	1,066	1,641	2,151	2,056	282	-1,968	-3,060	-3,258
60%	-2,219	-2,602	-2,967	-2,092	-314	884	1,828	1,415	13	-2,278	-3,763	-3,773
70%	-2,740	-3,082	-3,330	-2,363	-1,709	-252	1,518	1,130	-706	-2,909	-4,291	-3,947
80%	-3,336	-3,412	-3,547	-2,866	-2,513	-874	1,188	513	-1,399	-3,531	-4,804	-4,109
90%	-3,917	-3,663	-4,036	-3,611	-3,110	-1,605	763	-453	-2,023	-4,332	-5,168	-4,339
Long Term												
Full Simulation Period ^b	-1,596	-1,575	-246	3,386	6,363	6,391	5,778	4,362	1,925	-1,726	-2,729	-2,654
Water Year Types^c												
Wet (32%)	-2,042	-1,353	3,511	12,143	15,965	16,223	12,737	10,629	6,448	-533	-3,786	-2,986
Above Normal (16%)	-1,407	-1,408	-293	2,659	6,954	6,279	4,374	2,700	203	-2,384	-4,684	-4,210
Below Normal (13%)	-2,223	-2,535	-2,647	-2,770	3,655	366	2,198	847	-1,135	-4,288	-3,305	-3,131
Dry (24%)	-1,352	-1,850	-2,738	-1,663	-502	484	2,392	1,283	-289	-2,470	-1,259	-2,247
Critical (15%)	-666	-898	-1,983	-742	-1,155	580	1,146	938	485	-14	-243	-491

Alternative 1 minus No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-664	-876	-3,574	-1,768	2,736	2,930	-3,312	-5,631	226	149	-297	-69
20%	-463	-382	-1,936	-6,089	-801	1,533	-4,755	-4,487	167	-12	-461	-160
30%	-675	-1,232	-1,006	-3,311	-3,691	-1,115	-5,267	-3,728	-155	429	-264	-786
40%	-1,157	-1,396	-1,437	-3,087	-3,627	-1,862	-6,305	-3,780	-399	617	905	-631
50%	-1,768	-1,515	-1,505	-2,821	-3,829	-1,507	-5,539	-3,080	-740	597	792	-813
60%	-1,941	-1,246	-1,098	-3,018	-3,542	-1,681	-4,259	-1,524	-727	839	872	-762
70%	-2,242	-1,329	16	-1,975	-3,707	-2,049	-2,050	-1,053	-1,251	922	631	-215
80%	-2,565	-1,227	1,533	-1,824	-3,651	-2,215	-902	-763	-1,497	926	511	-59
90%	-2,340	-8	1,577	-2,294	-2,585	-2,431	-886	-1,381	-1,948	440	365	75
Long Term												
Full Simulation Period ^b	-1,444	-971	-600	-2,679	-2,427	-1,123	-3,546	-2,575	-366	500	317	-465
Water Year Types^c												
Wet (32%)	-1,883	-1,328	-1,496	-3,009	-1,229	445	-4,659	-3,734	1,013	136	656	-9
Above Normal (16%)	-973	-282	-492	-4,504	-3,034	-1,046	-5,717	-3,908	-707	-164	674	-2,602
Below Normal (13%)	-2,408	-1,480	224	-3,677	-2,233	-1,637	-3,858	-2,927	-1,908	-65	1,112	4
Dry (24%)	-1,186	-872	-6	-1,929	-3,482	-2,778	-2,147	-1,381	-827	1,451	-413	-142
Critical (15%)	-549	-640	-524	-322	-2,782	-1,372	-831	-291	-804	940	-317	-107

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-33-2. Qwest, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1,190	939	7,381	16,329	20,138	16,951	21,018	17,565	6,736	440	871	120
20%	515	53	1,563	11,264	12,704	10,469	13,927	9,636	3,197	-437	-453	-734
30%	215	-36	-367	5,662	10,982	7,517	10,386	6,993	1,869	-1,594	-1,445	-1,120
40%	59	-439	-908	3,520	7,240	5,489	9,345	6,123	1,385	-2,172	-2,923	-1,931
50%	13	-688	-1,266	2,051	4,895	3,149	7,690	5,136	1,021	-2,566	-3,852	-2,445
60%	-277	-1,356	-1,870	926	3,228	2,565	6,087	2,939	740	-3,117	-4,635	-3,011
70%	-498	-1,752	-3,347	-388	1,998	1,798	3,568	2,183	544	-3,831	-4,922	-3,732
80%	-771	-2,186	-5,079	-1,042	1,138	1,341	2,090	1,276	97	-4,457	-5,315	-4,050
90%	-1,577	-3,655	-5,613	-1,317	-525	826	1,649	929	-75	-4,771	-5,533	-4,414
Long Term												
Full Simulation Period ^b	-152	-604	354	6,065	8,790	7,514	9,325	6,938	2,291	-2,226	-3,046	-2,189
Water Year Types ^c												
Wet (32%)	-159	-25	5,007	15,152	17,194	15,778	17,396	14,363	5,435	-668	-4,441	-2,977
Above Normal (16%)	-434	-1,125	199	7,163	9,988	7,324	10,091	6,608	909	-2,220	-5,358	-1,608
Below Normal (13%)	185	-1,055	-2,871	908	5,888	2,004	6,057	3,774	773	-4,223	-4,418	-3,135
Dry (24%)	-166	-978	-2,732	266	2,980	3,262	4,539	2,664	538	-3,920	-846	-2,104
Critical (15%)	-118	-258	-1,458	-420	1,627	1,952	1,977	1,228	1,289	-954	74	-384

Alternative 3												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	83	73	6,891	16,697	23,223	20,213	15,887	10,799	4,840	710	346	66
20%	49	-17	1,659	10,215	12,269	10,204	8,880	3,919	1,899	-325	-670	-971
30%	-115	-844	38	6,317	10,027	6,380	5,473	2,022	631	-717	-1,640	-1,833
40%	-600	-1,792	-930	3,541	6,548	4,551	3,460	1,600	180	-1,862	-2,730	-2,462
50%	-1,730	-2,278	-1,568	2,754	4,145	2,910	3,048	1,243	-175	-2,431	-3,512	-3,217
60%	-2,231	-2,540	-2,531	1,900	2,573	2,148	2,142	1,036	-675	-2,945	-4,187	-3,653
70%	-2,815	-3,019	-3,073	841	1,626	1,517	1,694	609	-916	-3,376	-4,629	-3,809
80%	-3,331	-3,396	-3,382	65	567	806	1,255	288	-1,370	-4,175	-5,134	-4,063
90%	-3,941	-3,786	-3,798	-532	-963	-483	662	-390	-1,638	-4,926	-5,457	-4,430
Long Term												
Full Simulation Period ^b	-1,568	-1,486	783	6,530	8,539	7,092	5,910	3,725	1,179	-1,964	-2,963	-2,627
Water Year Types ^c												
Wet (32%)	-2,011	-1,326	5,481	14,861	16,783	15,532	12,500	9,420	4,460	-362	-3,821	-2,846
Above Normal (16%)	-1,488	-1,523	820	7,597	9,153	6,379	4,758	1,601	-233	-2,368	-5,066	-4,165
Below Normal (13%)	-2,014	-2,255	-2,401	1,759	5,969	1,128	2,884	1,043	-736	-4,525	-4,783	-3,620
Dry (24%)	-1,461	-1,779	-2,408	1,318	3,030	2,961	2,470	798	-649	-3,392	-1,162	-2,111
Critical (15%)	-467	-597	-1,196	387	1,547	1,928	1,383	1,023	400	-269	-158	-435

Alternative 3 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-1,107	-866	-489	368	3,084	3,263	-5,131	-6,766	-1,896	270	-526	-54
20%	-467	-70	96	-1,049	-435	-265	-5,048	-5,718	-1,298	112	-217	-237
30%	-329	-808	405	655	-955	-1,137	-4,913	-4,971	-1,238	877	-196	-713
40%	-659	-1,353	-22	20	-692	-938	-5,885	-4,523	-1,205	310	194	-532
50%	-1,743	-1,590	-301	703	-751	-239	-4,642	-3,892	-1,196	134	340	-772
60%	-1,953	-1,183	-661	974	-654	-417	-3,945	-1,903	-1,415	172	448	-642
70%	-2,318	-1,267	273	1,229	-372	-281	-1,874	-1,574	-1,460	455	293	-77
80%	-2,560	-1,210	1,698	1,107	-571	-535	-835	-989	-1,468	282	182	-13
90%	-2,364	-131	1,816	785	-438	-1,309	-987	-1,319	-1,563	-154	76	-16
Long Term												
Full Simulation Period ^b	-1,416	-882	429	465	-251	-423	-3,415	-3,213	-1,112	262	83	-438
Water Year Types ^c												
Wet (32%)	-1,852	-1,302	474	-291	-410	-246	-4,897	-4,943	-975	306	620	131
Above Normal (16%)	-1,055	-397	622	434	-834	-946	-5,332	-5,007	-1,143	-148	292	-2,557
Below Normal (13%)	-2,199	-1,200	469	851	81	-876	-3,172	-2,731	-1,509	-302	-365	-485
Dry (24%)	-1,295	-801	323	1,052	50	-301	-2,069	-1,866	-1,187	528	-316	-7
Critical (15%)	-349	-338	262	807	-80	-24	-594	-205	-888	685	-232	-51

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-33-3. Qwest, Monthly Flow

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,190	939	7,381	16,329	20,138	16,951	21,018	17,565	6,736	440	871	120
20%	515	53	1,563	11,264	12,704	10,469	13,927	9,636	3,197	-437	-453	-734
30%	215	-36	-367	5,662	10,982	7,517	10,386	6,993	1,869	-1,594	-1,445	-1,120
40%	59	-439	-908	3,520	7,240	5,489	9,345	6,123	1,385	-2,172	-2,923	-1,931
50%	13	-688	-1,266	2,051	4,895	3,149	7,690	5,136	1,021	-2,566	-3,852	-2,445
60%	-277	-1,356	-1,870	926	3,228	2,565	6,087	2,939	740	-3,117	-4,635	-3,011
70%	-498	-1,752	-3,347	-388	1,998	1,798	3,568	2,183	544	-3,831	-4,922	-3,732
80%	-771	-2,186	-5,079	-1,042	1,138	1,341	2,090	1,276	97	-4,457	-5,315	-4,050
90%	-1,577	-3,655	-5,613	-1,317	-525	826	1,649	929	-75	-4,771	-5,533	-4,414
Long Term												
Full Simulation Period ^b	-152	-604	354	6,065	8,790	7,514	9,325	6,938	2,291	-2,226	-3,046	-2,189
Water Year Types^c												
Wet (32%)	-159	-25	5,007	15,152	17,194	15,778	17,396	14,363	5,435	-668	-4,441	-2,977
Above Normal (16%)	-434	-1,125	199	7,163	9,988	7,324	10,091	6,608	909	-2,220	-5,358	-1,608
Below Normal (13%)	185	-1,055	-2,871	908	5,888	2,004	6,057	3,774	773	-4,223	-4,418	-3,135
Dry (24%)	-166	-978	-2,732	266	2,980	3,262	4,539	2,664	538	-3,920	-846	-2,104
Critical (15%)	-118	-258	-1,458	-420	1,627	1,952	1,977	1,228	1,289	-954	74	-384

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,313	968	7,282	16,331	20,138	16,955	21,014	17,566	6,728	437	81	120
20%	638	63	1,597	11,247	13,399	10,470	13,753	9,636	2,812	-820	-724	-747
30%	229	-54	-137	5,649	11,039	7,466	10,689	7,517	1,840	-1,646	-2,006	-1,275
40%	63	-389	-911	3,523	7,238	5,229	9,387	6,665	1,308	-2,129	-3,225	-1,958
50%	33	-628	-1,305	2,059	4,891	3,149	7,939	5,892	916	-2,560	-4,387	-2,417
60%	-304	-1,160	-1,901	635	3,241	2,564	6,513	4,370	682	-3,583	-4,645	-3,022
70%	-529	-1,607	-3,368	-267	1,998	1,797	4,975	3,342	316	-4,074	-4,946	-3,631
80%	-808	-2,205	-5,076	-1,042	1,131	1,339	4,199	3,100	38	-4,661	-5,317	-3,869
90%	-1,328	-3,634	-5,605	-1,318	-523	826	3,332	2,556	-228	-4,898	-5,527	-4,431
Long Term												
Full Simulation Period ^b	-126	-568	324	6,049	8,782	7,475	10,009	7,798	2,216	-2,354	-3,255	-2,188
Water Year Types^c												
Wet (32%)	-116	-170	4,930	15,168	17,253	15,677	17,395	14,643	5,404	-643	-4,504	-2,838
Above Normal (16%)	-494	-665	200	7,142	9,916	7,321	10,237	7,138	900	-2,243	-5,317	-1,571
Below Normal (13%)	244	-1,049	-2,835	903	5,803	1,948	6,741	4,691	713	-4,254	-4,527	-3,334
Dry (24%)	-104	-940	-2,793	263	2,969	3,260	6,004	4,146	362	-4,324	-1,270	-2,188
Critical (15%)	-124	-260	-1,433	-530	1,622	1,961	3,430	2,612	1,200	-1,154	-455	-399

Alternative 5 minus No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	124	28	-99	2	-1	4	-4	0	-8	-3	-790	0
20%	122	9	34	-17	695	1	-174	0	-385	-382	-271	-14
30%	14	-18	230	-13	57	-51	303	524	-29	-52	-561	-155
40%	4	50	-3	3	-2	-260	42	542	-77	43	-301	-27
50%	20	60	-39	8	-4	0	249	756	-105	5	-535	28
60%	-27	197	-31	-291	13	-1	426	1,431	-58	-466	-10	-11
70%	-31	145	-21	121	0	-1	1,407	1,159	-229	-243	-24	100
80%	-37	-19	3	0	-7	-2	2,109	1,824	-59	-204	-2	181
90%	250	21	8	-1	2	0	1,683	1,628	-153	-126	6	-17
Long Term												
Full Simulation Period ^b	26	36	-31	-16	-8	-40	684	860	-75	-128	-209	1
Water Year Types^c												
Wet (32%)	43	-146	-77	16	59	-102	-2	280	-31	25	-63	139
Above Normal (16%)	-60	460	1	-20	-72	-4	146	530	-10	-23	41	37
Below Normal (13%)	59	6	35	-5	-86	-55	684	918	-60	-31	-109	-199
Dry (24%)	62	38	-62	-3	-12	-2	1,465	1,482	-177	-404	-423	-84
Critical (15%)	-7	-2	26	-110	-5	8	1,453	1,383	-89	-200	-529	-15

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-33-4. Qwest, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	526	63	3,807	14,561	22,874	19,881	17,707	11,934	6,962	589	574	51
20%	52	-329	-373	5,175	11,903	12,002	9,173	5,150	3,364	-449	-914	-893
30%	-460	-1,268	-1,373	2,351	7,291	6,402	5,119	3,265	1,714	-1,165	-1,709	-1,906
40%	-1,099	-1,835	-2,345	434	3,614	3,627	3,040	2,343	986	-1,555	-2,018	-2,562
50%	-1,755	-2,203	-2,771	-770	1,066	1,641	2,151	2,056	282	-1,968	-3,060	-3,258
60%	-2,219	-2,602	-2,967	-2,092	-314	884	1,828	1,415	13	-2,278	-3,763	-3,773
70%	-2,740	-3,082	-3,330	-2,363	-1,709	-252	1,518	1,130	-706	-2,909	-4,291	-3,947
80%	-3,336	-3,412	-3,547	-2,866	-2,513	-874	1,188	513	-1,399	-3,531	-4,804	-4,109
90%	-3,917	-3,663	-4,036	-3,611	-3,110	-1,605	763	-453	-2,023	-4,332	-5,168	-4,339
Long Term												
Full Simulation Period ^b	-1,596	-1,575	-246	3,386	6,363	6,391	5,778	4,362	1,925	-1,726	-2,729	-2,654
Water Year Types^c												
Wet (32%)	-2,042	-1,353	3,511	12,143	15,965	16,223	12,737	10,629	6,448	-533	-3,786	-2,986
Above Normal (16%)	-1,407	-1,408	-293	2,659	6,954	6,279	4,374	2,700	203	-2,384	-4,684	-4,210
Below Normal (13%)	-2,223	-2,535	-2,647	-2,770	3,655	366	2,198	847	-1,135	-4,288	-3,305	-3,131
Dry (24%)	-1,352	-1,850	-2,738	-1,663	-502	484	2,392	1,283	-289	-2,470	-1,259	-2,247
Critical (15%)	-666	-898	-1,983	-742	-1,155	580	1,146	938	485	-14	-243	-491

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,190	939	7,381	16,329	20,138	16,951	21,018	17,565	6,736	440	871	120
20%	515	53	1,563	11,264	12,704	10,469	13,927	9,636	3,197	-437	-453	-734
30%	215	-36	-367	5,662	10,982	7,517	10,386	6,993	1,869	-1,594	-1,445	-1,120
40%	59	-439	-908	3,520	7,240	5,489	9,345	6,123	1,385	-2,172	-2,923	-1,931
50%	13	-688	-1,266	2,051	4,895	3,149	7,690	5,136	1,021	-2,566	-3,852	-2,445
60%	-277	-1,356	-1,870	926	3,228	2,565	6,087	2,939	740	-3,117	-4,635	-3,011
70%	-498	-1,752	-3,347	-388	1,998	1,798	3,568	2,183	544	-3,831	-4,922	-3,732
80%	-771	-2,186	-5,079	-1,042	1,138	1,341	2,090	1,276	97	-4,457	-5,315	-4,050
90%	-1,577	-3,655	-5,613	-1,317	-525	826	1,649	929	-75	-4,771	-5,533	-4,414
Long Term												
Full Simulation Period ^b	-152	-604	354	6,065	8,790	7,514	9,325	6,938	2,291	-2,226	-3,046	-2,189
Water Year Types^c												
Wet (32%)	-159	-25	5,007	15,152	17,194	15,778	17,396	14,363	5,435	-668	-4,441	-2,977
Above Normal (16%)	-434	-1,125	199	7,163	9,988	7,324	10,091	6,608	909	-2,220	-5,358	-1,608
Below Normal (13%)	185	-1,055	-2,871	908	5,888	2,004	6,057	3,774	773	-4,223	-4,418	-3,135
Dry (24%)	-166	-978	-2,732	266	2,980	3,262	4,539	2,664	538	-3,920	-846	-2,104
Critical (15%)	-118	-258	-1,458	-420	1,627	1,952	1,977	1,228	1,289	-954	74	-384

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	664	876	3,574	1,768	-2,736	-2,930	3,312	5,631	-226	-149	297	69
20%	463	382	1,936	6,089	801	-1,533	4,755	4,487	-167	12	461	160
30%	675	1,232	1,006	3,311	3,691	1,115	5,267	3,728	155	-429	264	786
40%	1,157	1,396	1,437	3,087	3,627	1,862	6,305	3,780	399	-617	-905	631
50%	1,768	1,515	1,505	2,821	3,829	1,507	5,539	3,080	740	-597	-792	813
60%	1,941	1,246	1,098	3,018	3,542	1,681	4,259	1,524	727	-839	-872	762
70%	2,242	1,329	-16	1,975	3,707	2,049	2,050	1,053	1,251	-922	-631	215
80%	2,565	1,227	-1,533	1,824	3,651	2,215	902	763	1,497	-926	-511	59
90%	2,340	8	-1,577	2,294	2,585	2,431	886	1,381	1,948	-440	-365	-75
Long Term												
Full Simulation Period ^b	1,444	971	600	2,679	2,427	1,123	3,546	2,575	366	-500	-317	465
Water Year Types^c												
Wet (32%)	1,883	1,328	1,496	3,009	1,229	-445	4,659	3,734	-1,013	-136	-656	9
Above Normal (16%)	973	282	492	4,504	3,034	1,046	5,717	3,908	707	164	-674	2,602
Below Normal (13%)	2,408	1,480	-224	3,677	2,233	1,637	3,858	2,927	1,908	65	-1,112	-4
Dry (24%)	1,186	872	6	1,929	3,482	2,778	2,147	1,381	827	-1,451	413	142
Critical (15%)	549	640	524	322	2,782	1,372	831	291	804	-940	317	107

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-33-5. Qwest, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	526	63	3,807	14,561	22,874	19,881	17,707	11,934	6,962	589	574	51
20%	52	-329	-373	5,175	11,903	12,002	9,173	5,150	3,364	-449	-914	-893
30%	-460	-1,268	-1,373	2,351	7,291	6,402	5,119	3,265	1,714	-1,165	-1,709	-1,906
40%	-1,099	-1,835	-2,345	434	3,614	3,627	3,040	2,343	986	-1,555	-2,018	-2,562
50%	-1,755	-2,203	-2,771	-770	1,066	1,641	2,151	2,056	282	-1,968	-3,060	-3,258
60%	-2,219	-2,602	-2,967	-2,092	-314	884	1,828	1,415	13	-2,278	-3,763	-3,773
70%	-2,740	-3,082	-3,330	-2,363	-1,709	-252	1,518	1,130	-706	-2,909	-4,291	-3,947
80%	-3,336	-3,412	-3,547	-2,866	-2,513	-874	1,188	513	-1,399	-3,531	-4,804	-4,109
90%	-3,917	-3,663	-4,036	-3,611	-3,110	-1,605	763	-453	-2,023	-4,332	-5,168	-4,339
Long Term												
Full Simulation Period ^b	-1,596	-1,575	-246	3,386	6,363	6,391	5,778	4,362	1,925	-1,726	-2,729	-2,654
Water Year Types^c												
Wet (32%)	-2,042	-1,353	3,511	12,143	15,965	16,223	12,737	10,629	6,448	-533	-3,786	-2,986
Above Normal (16%)	-1,407	-1,408	-293	2,659	6,954	6,279	4,374	2,700	203	-2,384	-4,684	-4,210
Below Normal (13%)	-2,223	-2,535	-2,647	-2,770	3,655	366	2,198	847	-1,135	-4,288	-3,305	-3,131
Dry (24%)	-1,352	-1,850	-2,738	-1,663	-502	484	2,392	1,283	-289	-2,470	-1,259	-2,247
Critical (15%)	-666	-898	-1,983	-742	-1,155	580	1,146	938	485	-14	-243	-491

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	83	73	6,891	16,697	23,223	20,213	15,887	10,799	4,840	710	346	66
20%	49	-17	1,659	10,215	12,269	10,204	8,880	3,919	1,899	-325	-670	-971
30%	-115	-844	38	6,317	10,027	6,380	5,473	2,022	631	-717	-1,640	-1,833
40%	-600	-1,792	-930	3,541	6,548	4,551	3,460	1,600	180	-1,862	-2,730	-2,462
50%	-1,730	-2,278	-1,568	2,754	4,145	2,910	3,048	1,243	-175	-2,431	-3,512	-3,217
60%	-2,231	-2,540	-2,531	1,900	2,573	2,148	2,142	1,036	-675	-2,945	-4,187	-3,653
70%	-2,815	-3,019	-3,073	841	1,626	1,517	1,694	609	-916	-3,376	-4,629	-3,809
80%	-3,331	-3,396	-3,382	65	567	806	1,255	288	-1,370	-4,175	-5,134	-4,063
90%	-3,941	-3,786	-3,798	-532	-963	-483	662	-390	-1,638	-4,926	-5,457	-4,430
Long Term												
Full Simulation Period ^b	-1,568	-1,486	783	6,530	8,539	7,092	5,910	3,725	1,179	-1,964	-2,963	-2,627
Water Year Types^c												
Wet (32%)	-2,011	-1,326	5,481	14,861	16,783	15,532	12,500	9,420	4,460	-362	-3,821	-2,846
Above Normal (16%)	-1,488	-1,523	820	7,597	9,153	6,379	4,758	1,601	-233	-2,368	-5,066	-4,165
Below Normal (13%)	-2,014	-2,255	-2,401	1,759	5,969	1,128	2,884	1,043	-736	-4,525	-4,783	-3,620
Dry (24%)	-1,461	-1,779	-2,408	1,318	3,030	2,961	2,470	798	-649	-3,392	-1,162	-2,111
Critical (15%)	-467	-597	-1,196	387	1,547	1,928	1,383	1,023	400	-269	-158	-435

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-443	10	3,084	2,136	349	333	-1,819	-1,135	-2,122	121	-229	16
20%	-4	312	2,032	5,040	365	-1,798	-293	-1,231	-1,465	124	244	-77
30%	345	424	1,412	3,966	2,736	-22	354	-1,243	-1,083	448	68	73
40%	498	43	1,415	3,107	2,934	924	420	-742	-806	-306	-712	100
50%	25	-75	1,203	3,524	3,079	1,268	897	-812	-456	-463	-452	41
60%	-12	62	436	3,991	2,888	1,264	314	-379	-689	-667	-424	120
70%	-76	63	257	3,204	3,335	1,768	176	-521	-210	-467	-339	138
80%	6	17	165	2,931	3,080	1,680	67	-225	29	-644	-330	46
90%	-24	-123	239	3,079	2,147	1,122	-101	63	386	-594	-289	-91
Long Term												
Full Simulation Period ^b	27	89	1,030	3,144	2,176	700	131	-637	-746	-238	-234	27
Water Year Types^c												
Wet (32%)	31	26	1,970	2,718	819	-691	-238	-1,209	-1,988	170	-36	140
Above Normal (16%)	-82	-115	1,113	4,938	2,200	100	385	-1,099	-436	16	-382	45
Below Normal (13%)	209	280	245	4,529	2,314	761	686	196	399	-237	-1,477	-489
Dry (24%)	-110	70	330	2,981	3,532	2,477	78	-485	-360	-923	98	136
Critical (15%)	199	302	786	1,129	2,702	1,348	237	85	-84	-255	85	56

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c AS defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-33-6. Qwest, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	526	63	3,807	14,561	22,874	19,881	17,707	11,934	6,962	589	574	51
20%	52	-329	-373	5,175	11,903	12,002	9,173	5,150	3,364	-449	-914	-893
30%	-460	-1,268	-1,373	2,351	7,291	6,402	5,119	3,265	1,714	-1,165	-1,709	-1,906
40%	-1,099	-1,835	-2,345	434	3,614	3,627	3,040	2,343	986	-1,555	-2,018	-2,562
50%	-1,755	-2,203	-2,771	-770	1,066	1,641	2,151	2,056	282	-1,968	-3,060	-3,258
60%	-2,219	-2,602	-2,967	-2,092	-314	884	1,828	1,415	13	-2,278	-3,763	-3,773
70%	-2,740	-3,082	-3,330	-2,363	-1,709	-252	1,518	1,130	-706	-2,909	-4,291	-3,947
80%	-3,336	-3,412	-3,547	-2,866	-2,513	-874	1,188	513	-1,399	-3,531	-4,804	-4,109
90%	-3,917	-3,663	-4,036	-3,611	-3,110	-1,605	763	-453	-2,023	-4,332	-5,168	-4,339
Long Term												
Full Simulation Period ^b	-1,596	-1,575	-246	3,386	6,363	6,391	5,778	4,362	1,925	-1,726	-2,729	-2,654
Water Year Types^c												
Wet (32%)	-2,042	-1,353	3,511	12,143	15,965	16,223	12,737	10,629	6,448	-533	-3,786	-2,986
Above Normal (16%)	-1,407	-1,408	-293	2,659	6,954	6,279	4,374	2,700	203	-2,384	-4,684	-4,210
Below Normal (13%)	-2,223	-2,535	-2,647	-2,770	3,655	366	2,198	847	-1,135	-4,288	-3,305	-3,131
Dry (24%)	-1,352	-1,850	-2,738	-1,663	-502	484	2,392	1,283	-289	-2,470	-1,259	-2,247
Critical (15%)	-666	-898	-1,983	-742	-1,155	580	1,146	938	485	-14	-243	-491

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,313	968	7,282	16,331	20,138	16,955	21,014	17,566	6,728	437	81	120
20%	638	63	1,597	11,247	13,399	10,470	13,753	9,636	2,812	-820	-724	-747
30%	229	-54	-137	5,649	11,039	7,466	10,689	7,517	1,840	-1,646	-2,006	-1,275
40%	63	-389	-911	3,523	7,238	5,229	9,387	6,665	1,308	-2,129	-3,225	-1,958
50%	33	-628	-1,305	2,059	4,891	3,149	7,939	5,892	916	-2,560	-4,387	-2,417
60%	-304	-1,160	-1,901	635	3,241	2,564	6,513	4,370	682	-3,583	-4,645	-3,022
70%	-529	-1,607	-3,368	-267	1,998	1,797	4,975	3,342	316	-4,074	-4,946	-3,631
80%	-808	-2,205	-5,076	-1,042	1,131	1,339	4,199	3,100	38	-4,661	-5,317	-3,869
90%	-1,328	-3,634	-5,605	-1,318	-523	826	3,332	2,556	-228	-4,898	-5,527	-4,431
Long Term												
Full Simulation Period ^b	-126	-568	324	6,049	8,782	7,475	10,009	7,798	2,216	-2,354	-3,255	-2,188
Water Year Types^c												
Wet (32%)	-116	-170	4,930	15,168	17,253	15,677	17,395	14,643	5,404	-643	-4,504	-2,838
Above Normal (16%)	-494	-665	200	7,142	9,916	7,321	10,237	7,138	900	-2,243	-5,317	-1,571
Below Normal (13%)	244	-1,049	-2,835	903	5,803	1,948	6,741	4,691	713	-4,254	-4,527	-3,334
Dry (24%)	-104	-940	-2,793	263	2,969	3,260	6,004	4,146	362	-4,324	-1,270	-2,188
Critical (15%)	-124	-260	-1,433	-530	1,622	1,961	3,430	2,612	1,200	-1,154	-455	-399

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	787	904	3,475	1,770	-2,737	-2,926	3,308	5,632	-234	-152	-493	69
20%	585	391	1,970	6,072	1,495	-1,532	4,580	4,487	-552	-370	190	146
30%	689	1,214	1,237	3,298	3,748	1,064	5,570	4,252	126	-481	-297	631
40%	1,161	1,446	1,434	3,090	3,625	1,602	6,347	4,322	322	-574	-1,207	604
50%	1,787	1,575	1,466	2,829	3,825	1,508	5,787	3,836	634	-592	-1,327	841
60%	1,915	1,442	1,066	2,726	3,555	1,680	4,685	2,955	669	-1,305	-882	751
70%	2,211	1,474	-37	2,096	3,706	2,049	3,457	2,212	1,022	-1,165	-655	316
80%	2,528	1,208	-1,530	1,824	3,643	2,213	3,011	2,587	1,438	-1,129	-513	240
90%	2,590	29	-1,568	2,293	2,588	2,431	2,569	3,009	1,795	-566	-359	-92
Long Term												
Full Simulation Period ^b	1,470	1,007	570	2,663	2,419	1,083	4,231	3,435	291	-627	-525	466
Water Year Types^c												
Wet (32%)	1,927	1,182	1,419	3,025	1,288	-547	4,657	4,014	-1,043	-110	-718	148
Above Normal (16%)	913	742	493	4,484	2,962	1,042	5,863	4,438	697	141	-633	2,639
Below Normal (13%)	2,467	1,487	-189	3,672	2,148	1,582	4,542	3,844	1,847	34	-1,222	-202
Dry (24%)	1,248	910	-56	1,926	3,471	2,776	3,612	2,863	651	-1,855	-10	58
Critical (15%)	542	638	550	213	2,776	1,380	2,284	1,674	715	-1,140	-212	93

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1 **C.34. San Joaquin River Flow at Vernalis**


Figure C-34-1. San Joaquin River at Vernalis, Long-Term* Average Flow

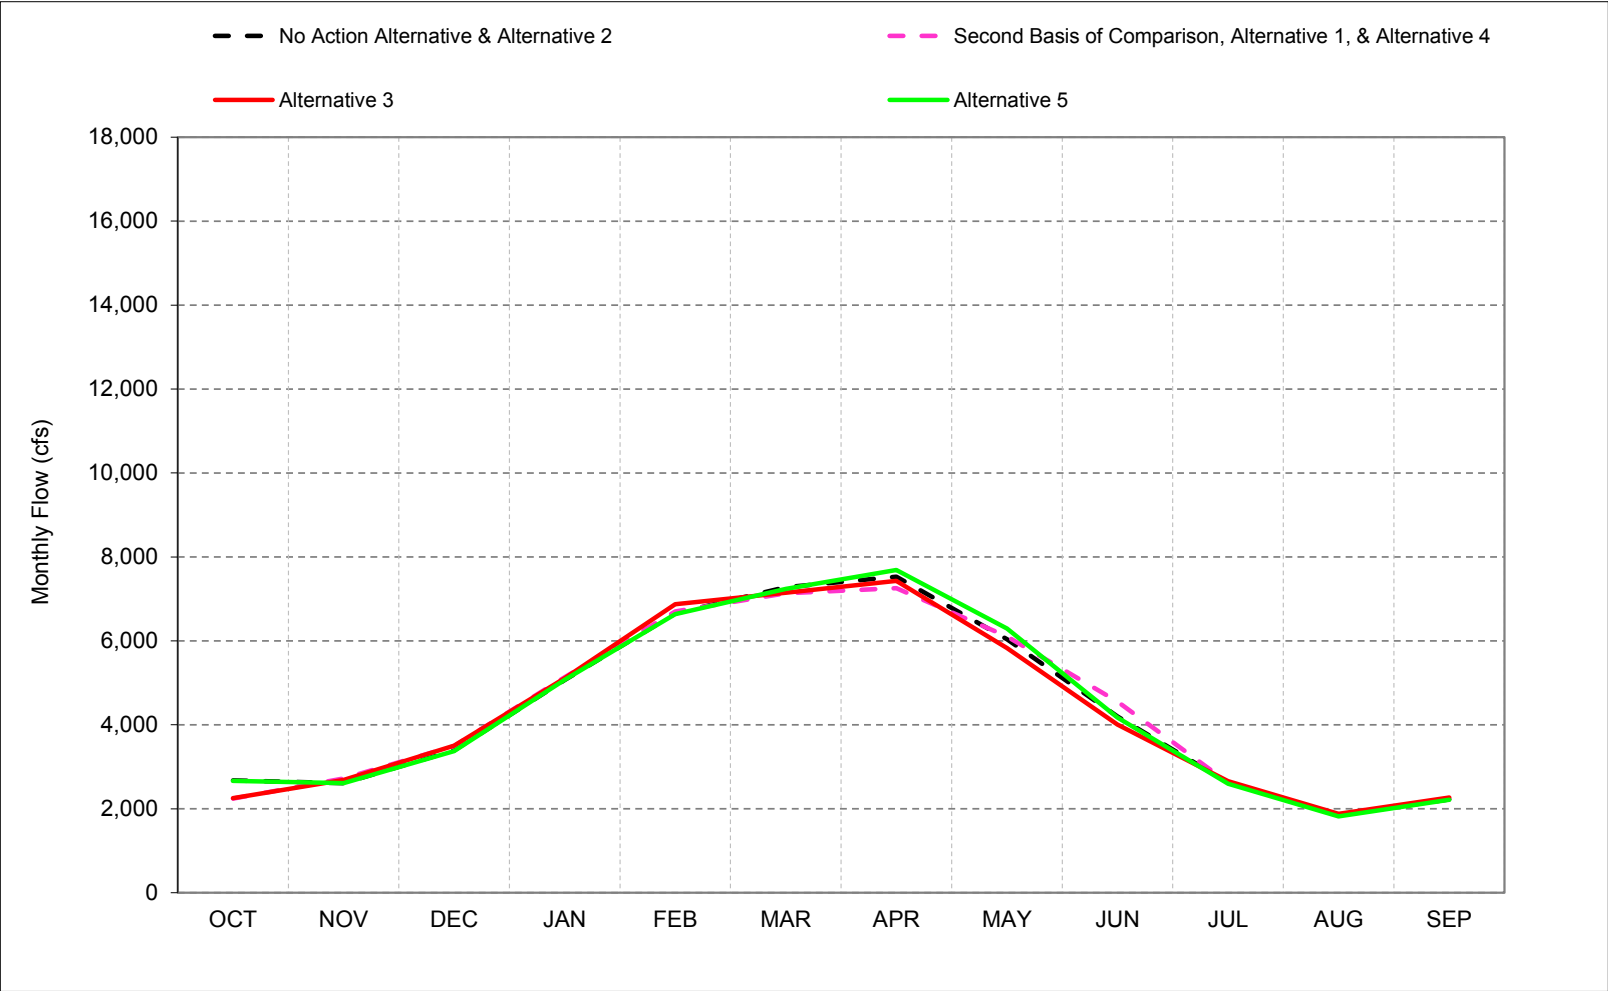

*Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-34-2. San Joaquin River at Vernalis, Wet Year* Long-Term** Average Flow

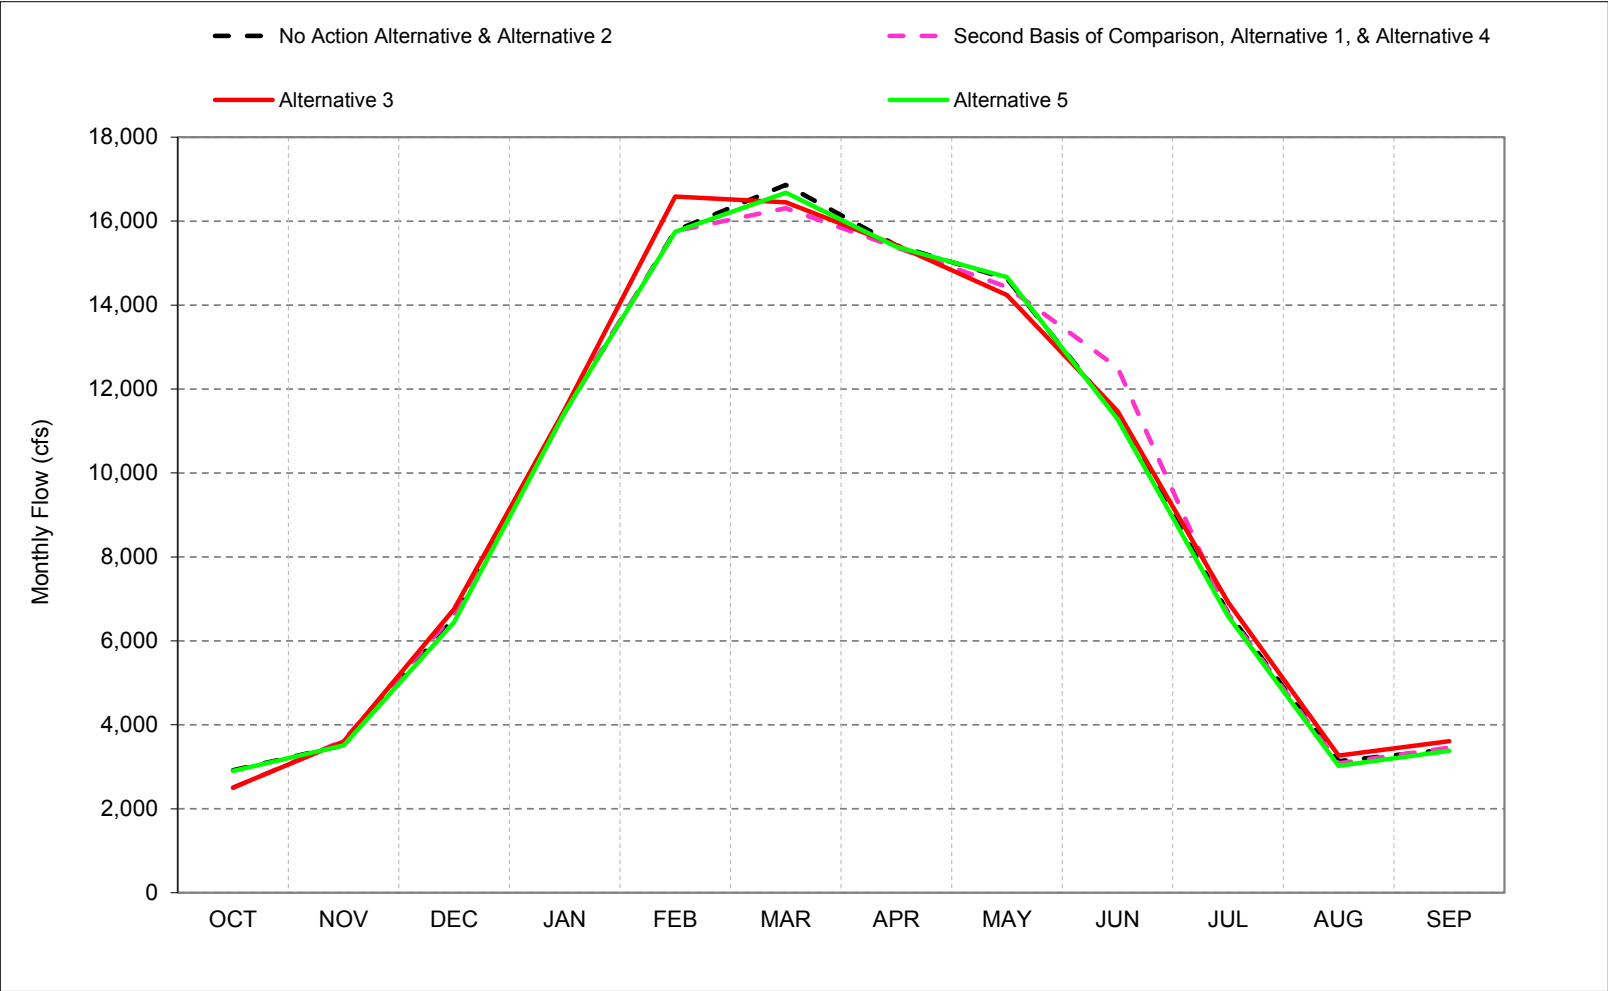


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-34-3. San Joaquin River at Vernalis, Above Normal Year* Long-Term** Average Flow

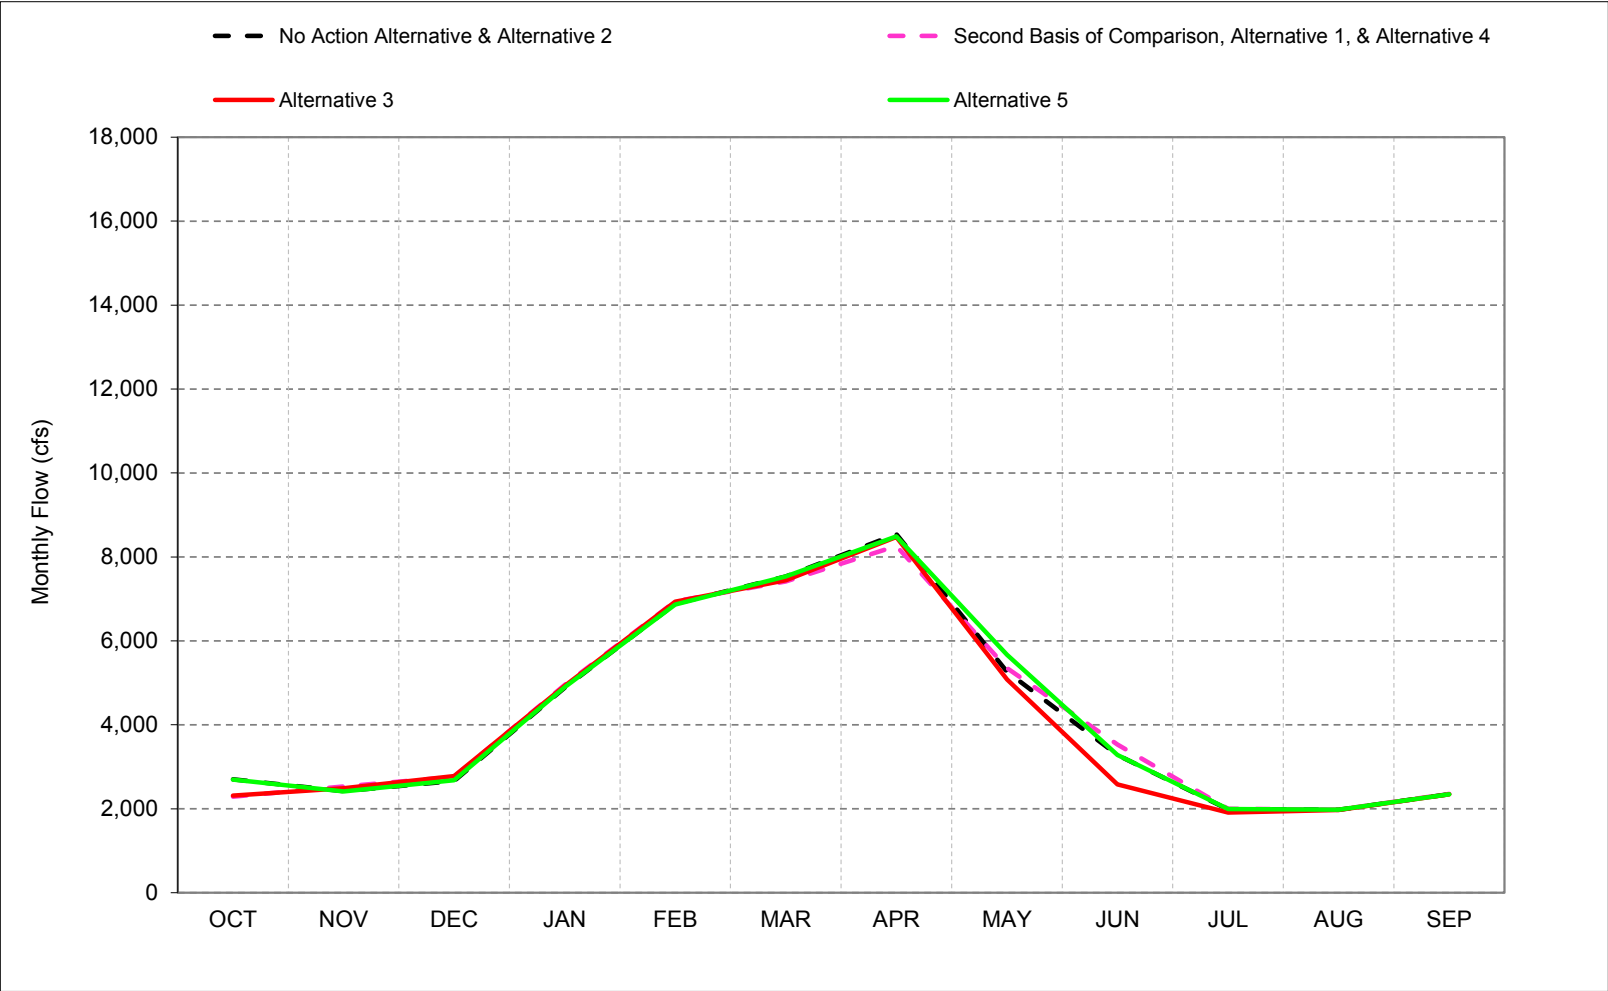


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-34-4. San Joaquin River at Vernalis, Below Normal Year* Long-Term** Average Flow

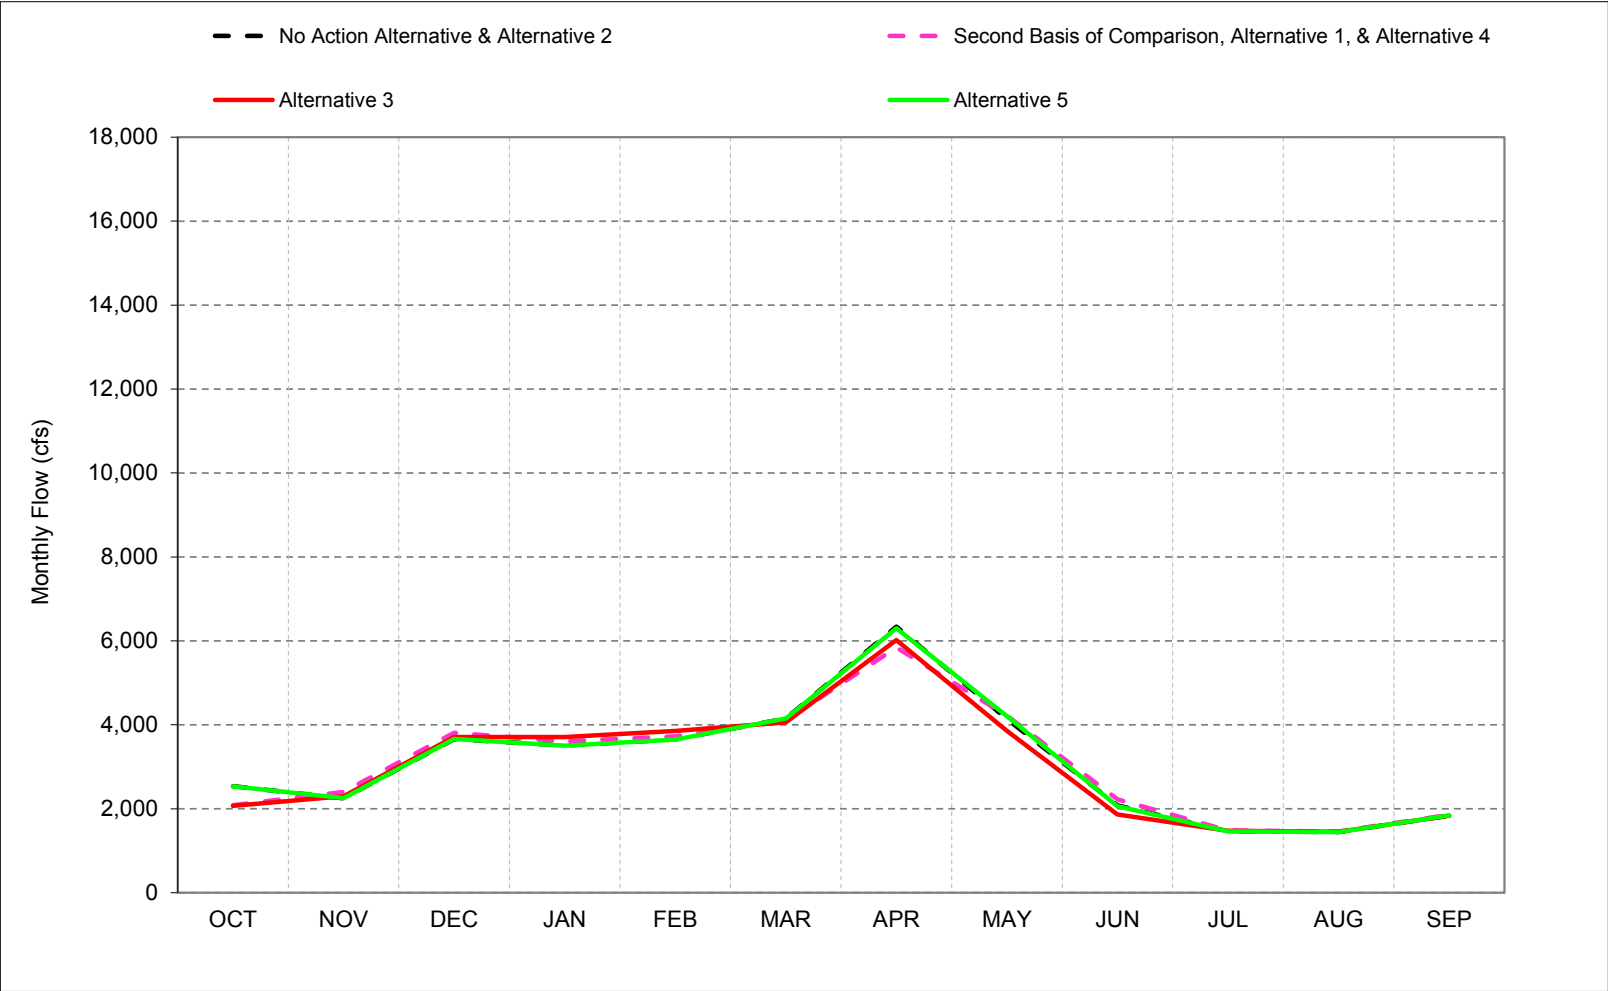


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-34-5. San Joaquin River at Vernalis, Dry Year* Long-Term** Average Flow

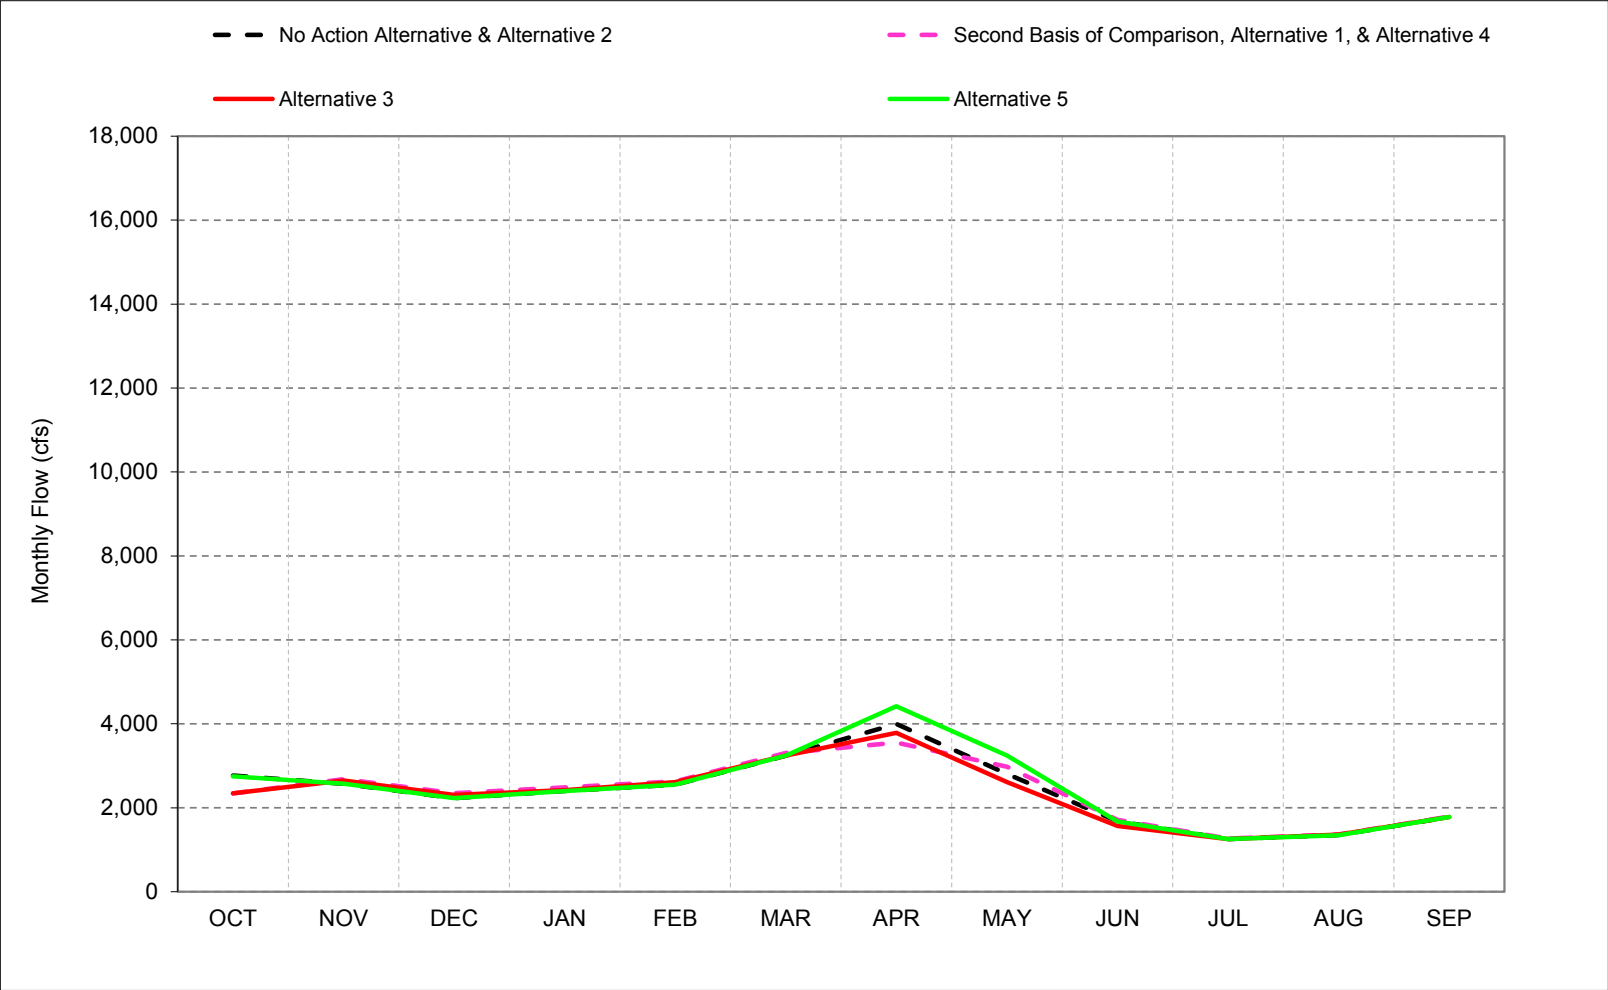


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-34-6. San Joaquin River at Vernalis, Critical Year* Long-Term** Average Flow

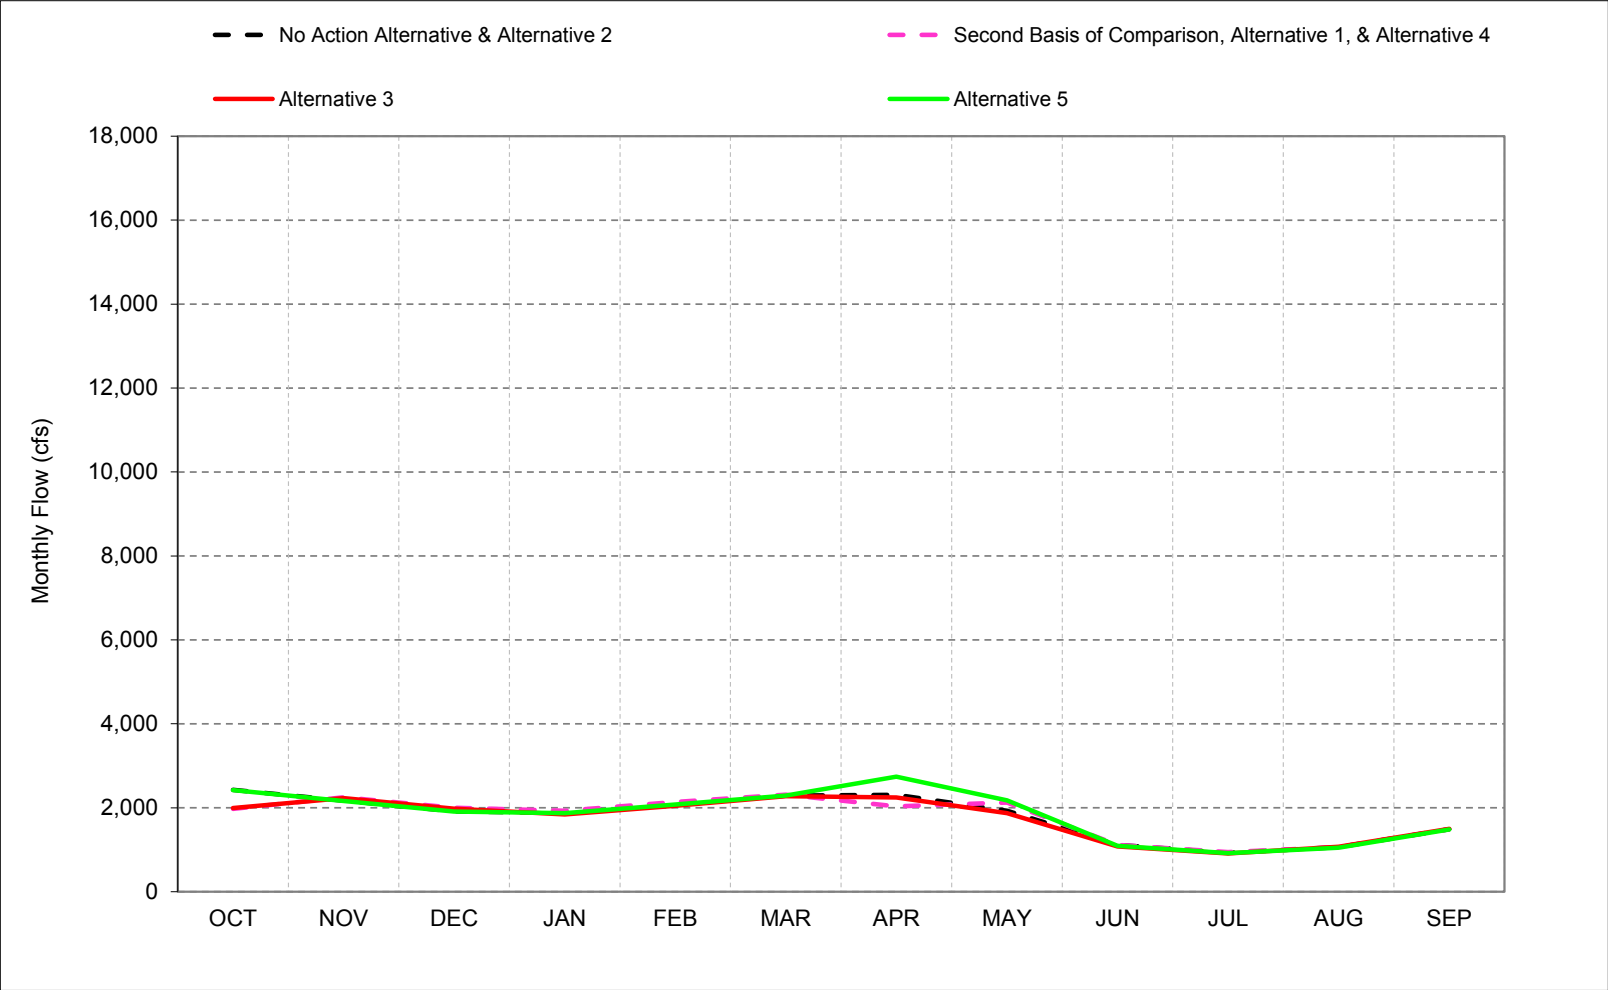

*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-34-1. San Joaquin River at Vernalis, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,498	2,953	4,804	11,135	14,596	15,471	14,974	14,174	9,351	5,890	2,796	3,060
20%	3,161	2,777	2,857	4,812	10,143	10,197	10,637	8,318	4,690	2,628	2,589	2,654
30%	2,980	2,527	2,401	3,610	6,118	8,459	8,616	5,534	3,364	1,985	1,904	2,490
40%	2,796	2,395	2,215	2,629	4,232	5,570	7,564	4,609	2,947	1,735	1,666	2,125
50%	2,601	2,219	2,101	2,402	3,420	3,847	6,017	3,925	2,246	1,487	1,488	1,930
60%	2,401	2,169	2,046	2,293	2,683	3,459	4,832	3,062	1,859	1,366	1,403	1,835
70%	2,247	2,059	1,979	2,114	2,305	2,906	3,776	2,699	1,448	1,154	1,307	1,739
80%	1,994	1,951	1,829	1,884	2,150	2,371	2,789	2,153	1,293	1,087	1,202	1,611
90%	1,849	1,763	1,669	1,699	1,947	2,204	1,887	1,678	1,085	885	1,067	1,476
Long Term												
Full Simulation Period ^b	2,672	2,611	3,391	5,070	6,655	7,278	7,528	6,039	4,194	2,622	1,847	2,223
Water Year Types^c												
Wet (23%)	2,918	3,513	6,545	11,446	15,776	16,863	15,423	14,628	11,335	6,676	3,135	3,416
Above Normal (24%)	2,700	2,416	2,663	4,883	6,881	7,536	8,542	5,264	3,280	1,989	1,975	2,345
Below Normal (10%)	2,538	2,249	3,661	3,507	3,651	4,149	6,337	4,140	2,076	1,463	1,446	1,837
Dry (16%)	2,767	2,569	2,232	2,402	2,549	3,241	3,996	2,805	1,680	1,254	1,347	1,776
Critical (27%)	2,426	2,168	1,915	1,877	2,090	2,288	2,307	1,929	1,115	926	1,060	1,487
Alternative 1												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,015	3,156	4,932	11,157	14,594	15,467	14,666	14,360	10,139	5,612	2,740	3,146
20%	2,692	2,843	2,953	4,819	10,200	9,482	10,169	8,291	5,696	2,636	2,600	2,658
30%	2,520	2,663	2,541	3,655	6,300	7,933	8,421	5,676	3,488	1,990	1,897	2,503
40%	2,331	2,500	2,341	2,692	4,268	5,393	7,435	4,617	3,188	1,742	1,676	2,142
50%	2,157	2,386	2,257	2,544	3,420	3,883	6,016	4,043	2,349	1,506	1,500	1,944
60%	1,952	2,244	2,165	2,343	2,774	3,511	4,349	3,276	1,895	1,379	1,415	1,842
70%	1,752	2,141	2,027	2,153	2,443	2,963	3,119	2,891	1,485	1,170	1,321	1,743
80%	1,597	1,984	1,903	1,923	2,174	2,414	2,442	2,362	1,274	1,088	1,211	1,611
90%	1,411	1,793	1,699	1,733	1,945	2,230	1,779	1,890	1,085	941	1,071	1,478
Long Term												
Full Simulation Period ^b	2,241	2,721	3,492	5,136	6,700	7,131	7,255	6,101	4,547	2,625	1,838	2,238
Water Year Types^c												
Wet (23%)	2,497	3,627	6,644	11,506	15,763	16,308	15,374	14,433	12,512	6,641	3,078	3,456
Above Normal (24%)	2,288	2,532	2,757	4,947	6,946	7,415	8,260	5,348	3,525	1,999	1,977	2,352
Below Normal (10%)	2,086	2,397	3,810	3,608	3,723	4,101	5,842	4,213	2,225	1,481	1,457	1,856
Dry (16%)	2,339	2,684	2,347	2,487	2,628	3,304	3,551	2,976	1,714	1,267	1,362	1,789
Critical (27%)	1,974	2,251	1,998	1,927	2,138	2,311	2,031	2,122	1,116	943	1,059	1,485
Alternative 1 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-483	203	128	23	-2	-4	-308	186	788	-278	-56	86
20%	-469	65	96	7	57	-714	-468	-26	1,006	8	11	4
30%	-460	136	141	44	182	-526	-195	142	124	5	-7	13
40%	-465	105	125	64	36	-177	-129	8	241	8	10	17
50%	-444	166	156	143	0	36	-2	118	103	20	12	14
60%	-449	75	119	50	91	52	-483	214	36	14	13	7
70%	-494	82	48	39	139	57	-657	192	37	15	14	4
80%	-397	33	74	40	23	43	-347	209	-19	1	9	1
90%	-438	30	30	34	-2	26	-108	213	0	56	5	2
Long Term												
Full Simulation Period ^b	-431	110	101	66	45	-147	-273	61	353	3	-9	14
Water Year Types^c												
Wet (23%)	-420	114	99	60	-13	-555	-49	-195	1,177	-35	-57	40
Above Normal (24%)	-412	116	94	63	65	-121	-282	83	244	10	2	7
Below Normal (10%)	-452	148	148	102	72	-49	-495	74	149	18	11	19
Dry (16%)	-428	115	115	85	79	63	-445	171	33	12	15	13
Critical (27%)	-452	83	83	49	48	23	-276	194	2	17	-1	-2
<small>a Exceedance probability is defined as the probability a given value will be exceeded in any one year.</small>												
<small>b Based on the 82-year simulation period.</small>												
<small>c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.</small>												
<small>Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.</small>												

Table C-34-2. San Joaquin River at Vernalis, Monthly Flow

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3,498	2,953	4,804	11,135	14,596	15,471	14,974	14,174	9,351	5,890	2,796	3,060
20%	3,161	2,777	2,857	4,812	10,143	10,197	10,637	8,318	4,690	2,628	2,589	2,654
30%	2,980	2,527	2,401	3,610	6,118	8,459	8,616	5,534	3,364	1,985	1,904	2,490
40%	2,796	2,395	2,215	2,629	4,232	5,570	7,564	4,609	2,947	1,735	1,666	2,125
50%	2,601	2,219	2,101	2,402	3,420	3,847	6,017	3,925	2,246	1,487	1,488	1,930
60%	2,401	2,169	2,046	2,293	2,683	3,459	4,832	3,062	1,859	1,366	1,403	1,835
70%	2,247	2,059	1,979	2,114	2,305	2,906	3,776	2,699	1,448	1,154	1,307	1,739
80%	1,994	1,951	1,829	1,884	2,150	2,371	2,789	2,153	1,293	1,087	1,202	1,611
90%	1,849	1,763	1,669	1,699	1,947	2,204	1,887	1,678	1,085	885	1,067	1,476
Long Term												
Full Simulation Period ^b	2,672	2,611	3,391	5,070	6,655	7,278	7,528	6,039	4,194	2,622	1,847	2,223
Water Year Types ^c												
Wet (23%)	2,918	3,513	6,545	11,446	15,776	16,863	15,423	14,628	11,335	6,676	3,135	3,416
Above Normal (24%)	2,700	2,416	2,663	4,883	6,881	7,536	8,542	5,264	3,280	1,989	1,975	2,345
Below Normal (10%)	2,538	2,249	3,661	3,507	3,651	4,149	6,337	4,140	2,076	1,463	1,446	1,837
Dry (16%)	2,767	2,569	2,232	2,402	2,549	3,241	3,996	2,805	1,680	1,254	1,347	1,776
Critical (27%)	2,426	2,168	1,915	1,877	2,090	2,288	2,307	1,929	1,115	926	1,060	1,487

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3,023	3,053	4,949	12,089	17,246	15,467	14,936	14,309	10,004	6,473	3,525	3,287
20%	2,667	2,830	2,938	4,833	10,213	9,874	10,251	7,931	4,627	2,495	2,587	2,623
30%	2,494	2,583	2,421	3,540	6,797	7,753	8,532	5,438	2,558	1,926	1,892	2,464
40%	2,328	2,478	2,304	2,753	4,210	5,305	7,580	4,344	2,294	1,722	1,667	2,125
50%	2,137	2,313	2,191	2,439	3,215	3,847	6,112	3,821	1,955	1,506	1,495	1,932
60%	1,956	2,244	2,140	2,236	2,668	3,440	4,501	2,907	1,700	1,361	1,415	1,838
70%	1,782	2,148	2,012	2,088	2,360	2,906	3,355	2,502	1,364	1,164	1,319	1,743
80%	1,609	1,974	1,886	1,824	2,090	2,371	2,581	2,158	1,241	1,026	1,211	1,612
90%	1,466	1,763	1,669	1,639	1,849	2,205	1,936	1,650	1,001	930	1,065	1,477
Long Term												
Full Simulation Period ^b	2,252	2,683	3,501	5,108	6,872	7,145	7,431	5,830	4,009	2,655	1,882	2,271
Water Year Types ^c												
Wet (23%)	2,505	3,604	6,760	11,512	16,584	16,445	15,425	14,237	11,476	6,916	3,267	3,610
Above Normal (24%)	2,310	2,488	2,775	4,925	6,937	7,444	8,476	5,078	2,579	1,910	1,972	2,341
Below Normal (10%)	2,067	2,299	3,711	3,708	3,857	4,057	6,015	3,856	1,865	1,472	1,454	1,834
Dry (16%)	2,346	2,646	2,309	2,419	2,607	3,241	3,785	2,611	1,568	1,253	1,360	1,782
Critical (27%)	1,991	2,227	1,974	1,842	2,043	2,273	2,247	1,874	1,080	912	1,067	1,497

Alternative 3 minus No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-474	100	146	954	2,651	-4	-38	135	653	582	729	227
20%	-495	53	80	21	70	-322	-386	-387	-63	-134	-2	-31
30%	-486	56	20	-71	679	-706	-84	-95	-806	-59	-11	-25
40%	-468	83	89	124	-22	-264	17	-265	-653	-12	1	0
50%	-464	94	91	37	-205	1	95	-104	-291	19	6	3
60%	-444	75	94	-57	-15	-19	-331	-155	-159	-5	13	3
70%	-465	89	33	-26	55	0	-421	-197	-83	10	12	4
80%	-385	23	56	-59	-60	1	-208	5	-52	-61	9	2
90%	-382	0	0	-59	-98	1	49	-27	-84	45	-1	1
Long Term												
Full Simulation Period ^b	-420	72	110	38	218	-132	-97	-209	-186	33	35	47
Water Year Types ^c												
Wet (23%)	-412	91	215	66	808	-418	2	-391	141	240	132	194
Above Normal (24%)	-390	72	112	42	56	-93	-66	-186	-701	-79	-3	-4
Below Normal (10%)	-471	50	50	201	206	-92	-322	-284	-210	9	8	-3
Dry (16%)	-421	77	77	17	58	1	-212	-194	-112	-2	13	6
Critical (27%)	-435	59	59	-35	-47	-15	-61	-54	-34	-14	7	10

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

1/0/1900

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3,498	2,953	4,804	11,135	14,596	15,471	14,974	14,174	9,351	5,890	2,796	3,060
20%	3,161	2,777	2,857	4,812	10,143	10,197	10,637	8,318	4,690	2,628	2,589	2,654
30%	2,980	2,527	2,401	3,610	6,118	8,459	8,616	5,534	3,364	1,985	1,904	2,490
40%	2,796	2,395	2,215	2,629	4,232	5,570	7,564	4,609	2,947	1,735	1,666	2,125
50%	2,601	2,219	2,101	2,402	3,420	3,847	6,017	3,925	2,246	1,487	1,488	1,930
60%	2,401	2,169	2,046	2,293	2,683	3,459	4,832	3,062	1,859	1,366	1,403	1,835
70%	2,247	2,059	1,979	2,114	2,305	2,906	3,776	2,699	1,448	1,154	1,307	1,739
80%	1,994	1,951	1,829	1,884	2,150	2,371	2,789	2,153	1,293	1,087	1,202	1,611
90%	1,849	1,763	1,669	1,699	1,947	2,204	1,887	1,678	1,085	885	1,067	1,476
Long Term												
Full Simulation Period ^b	2,672	2,611	3,391	5,070	6,655	7,278	7,528	6,039	4,194	2,622	1,847	2,223
Water Year Types ^c												
Wet (23%)	2,918	3,513	6,545	11,446	15,776	16,863	15,423	14,628	11,335	6,676	3,135	3,416
Above Normal (24%)	2,700	2,416	2,663	4,883	6,881	7,536	8,542	5,264	3,280	1,989	1,975	2,345
Below Normal (10%)	2,538	2,249	3,661	3,507	3,651	4,149	6,337	4,140	2,076	1,463	1,446	1,837
Dry (16%)	2,767	2,569	2,232	2,402	2,549	3,241	3,996	2,805	1,680	1,254	1,347	1,776
Critical (27%)	2,426	2,168	1,915	1,877	2,090	2,288	2,307	1,929	1,115	926	1,060	1,487

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3,495	2,953	4,804	11,129	14,597	15,473	14,976	14,176	9,351	5,773	2,776	3,084
20%	3,146	2,777	2,897	4,811	10,142	9,856	10,265	8,232	4,688	2,628	2,589	2,654
30%	2,938	2,527	2,401	3,610	6,118	8,461	8,576	5,670	3,364	1,985	1,904	2,488
40%	2,763	2,395	2,204	2,629	4,232	5,570	7,567	5,162	2,947	1,735	1,666	2,125
50%	2,588	2,219	2,101	2,402	3,420	3,846	6,110	4,183	2,219	1,484	1,488	1,930
60%	2,385	2,169	2,046	2,289	2,683	3,459	5,047	3,554	1,860	1,365	1,402	1,835
70%	2,196	2,059	1,979	2,083	2,303	2,906	4,317	2,916	1,447	1,155	1,307	1,739
80%	1,988	1,951	1,829	1,883	2,145	2,371	3,100	2,401	1,283	1,052	1,202	1,611
90%	1,849	1,763	1,669	1,699	1,947	2,204	2,461	2,245	1,000	885	1,025	1,431
Long Term												
Full Simulation Period ^b	2,660	2,609	3,371	5,071	6,639	7,235	7,686	6,290	4,174	2,597	1,818	2,213
Water Year Types ^c												
Wet (23%)	2,903	3,513	6,448	11,445	15,743	16,679	15,389	14,666	11,287	6,580	3,020	3,379
Above Normal (24%)	2,691	2,411	2,679	4,897	6,864	7,536	8,487	5,671	3,280	1,989	1,975	2,345
Below Normal (10%)	2,531	2,249	3,661	3,506	3,650	4,149	6,299	4,206	2,062	1,462	1,446	1,837
Dry (16%)	2,750	2,569	2,232	2,400	2,547	3,241	4,420	3,245	1,672	1,253	1,346	1,776
Critical (27%)	2,418	2,163	1,910	1,871	2,078	2,288	2,741	2,177	1,090	916	1,051	1,480

Alternative 5 minus No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-2	0	0	-6	1	2	2	2	0	-117	-20	24
20%	-16	0	39	0	0	-341	-372	-86	-2	-1	0	0
30%	-42	0	0	0	0	1	-40	136	0	0	0	-1
40%	-32	0	-11	0	0	0	3	553	0	0	0	0
50%	-14	0	0	0	0	0	92	258	-26	-3	0	0
60%	-15	0	0	-4	0	0	215	492	0	-1	0	0
70%	-51	0	0	-31	-2	0	541	216	0	1	0	0
80%	-7	0	0	0	-6	0	311	248	-10	-36	0	0
90%	0	0	0	0	0	0	574	568	-85	0	-42	-45
Long Term												
Full Simulation Period ^b	-11	-2	-20	1	-15	-43	158	251	-20	-25	-29	-11
Water Year Types ^c												
Wet (23%)	-15	0	-97	0	-32	-185	-34	38	-47	-96	-115	-38
Above Normal (24%)	-9	-5	16	13	-17	0	-55	407	0	0	0	0
Below Normal (10%)	-7	0	0	-1	-1	0	-38	66	-14	0	0	0
Dry (16%)	-17	0	0	-2	-2	0	424	439	-9	-1	-1	0
Critical (27%)	-8	-5	-5	-6	-13	0	434	248	-24	-10	-9	-7

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-34-4. San Joaquin River at Vernalis, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,015	3,156	4,932	11,157	14,594	15,467	14,666	14,360	10,139	5,612	2,740	3,146
20%	2,692	2,843	2,953	4,819	10,200	9,482	10,169	8,291	5,696	2,636	2,600	2,658
30%	2,520	2,663	2,541	3,655	6,300	7,933	8,421	5,676	3,488	1,990	1,897	2,503
40%	2,331	2,500	2,341	2,692	4,268	5,393	7,435	4,617	3,188	1,742	1,676	2,142
50%	2,157	2,386	2,257	2,544	3,420	3,883	6,016	4,043	2,349	1,506	1,500	1,944
60%	1,952	2,244	2,165	2,343	2,774	3,511	4,349	3,276	1,895	1,379	1,415	1,842
70%	1,752	2,141	2,027	2,153	2,443	2,963	3,119	2,891	1,485	1,170	1,321	1,743
80%	1,597	1,984	1,903	1,923	2,174	2,414	2,442	2,362	1,274	1,088	1,211	1,611
90%	1,411	1,793	1,699	1,733	1,945	2,230	1,779	1,890	1,085	941	1,071	1,478
Long Term												
Full Simulation Period ^b	2,241	2,721	3,492	5,136	6,700	7,131	7,255	6,101	4,547	2,625	1,838	2,238
Water Year Types^c												
Wet (23%)	2,497	3,627	6,644	11,506	15,763	16,308	15,374	14,433	12,512	6,641	3,078	3,456
Above Normal (24%)	2,288	2,532	2,757	4,947	6,946	7,415	8,260	5,348	3,525	1,999	1,977	2,352
Below Normal (10%)	2,086	2,397	3,810	3,608	3,723	4,101	5,842	4,213	2,225	1,481	1,457	1,856
Dry (16%)	2,339	2,684	2,347	2,487	2,628	3,304	3,551	2,976	1,714	1,267	1,362	1,789
Critical (27%)	1,974	2,251	1,998	1,927	2,138	2,311	2,031	2,122	1,116	943	1,059	1,485

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,498	2,953	4,804	11,135	14,596	15,471	14,974	14,174	9,351	5,890	2,796	3,060
20%	3,161	2,777	2,857	4,812	10,143	10,197	10,637	8,318	4,690	2,628	2,589	2,654
30%	2,980	2,527	2,401	3,610	6,118	8,459	8,616	5,534	3,364	1,985	1,904	2,490
40%	2,796	2,395	2,215	2,629	4,232	5,570	7,564	4,609	2,947	1,735	1,666	2,125
50%	2,601	2,219	2,101	2,402	3,420	3,847	6,017	3,925	2,246	1,487	1,488	1,930
60%	2,401	2,169	2,046	2,293	2,683	3,459	4,832	3,062	1,859	1,366	1,403	1,835
70%	2,247	2,059	1,979	2,114	2,305	2,906	3,776	2,699	1,448	1,154	1,307	1,739
80%	1,994	1,951	1,829	1,884	2,150	2,371	2,789	2,153	1,293	1,087	1,202	1,611
90%	1,849	1,763	1,669	1,699	1,947	2,204	1,887	1,678	1,085	885	1,067	1,476
Long Term												
Full Simulation Period ^b	2,672	2,611	3,391	5,070	6,655	7,278	7,528	6,039	4,194	2,622	1,847	2,223
Water Year Types^c												
Wet (23%)	2,918	3,513	6,545	11,446	15,776	16,863	15,423	14,628	11,335	6,676	3,135	3,416
Above Normal (24%)	2,700	2,416	2,663	4,883	6,881	7,536	8,542	5,264	3,280	1,989	1,975	2,345
Below Normal (10%)	2,538	2,249	3,661	3,507	3,651	4,149	6,337	4,140	2,076	1,463	1,446	1,837
Dry (16%)	2,767	2,569	2,232	2,402	2,549	3,241	3,996	2,805	1,680	1,254	1,347	1,776
Critical (27%)	2,426	2,168	1,915	1,877	2,090	2,288	2,307	1,929	1,115	926	1,060	1,487

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	483	-203	-128	-23	2	4	308	-186	-788	278	56	-86
20%	469	-65	-96	-7	-57	714	468	26	-1,006	-8	-11	-4
30%	460	-136	-141	-44	-182	526	195	-142	-124	-5	7	-13
40%	465	-105	-125	-64	-36	177	129	-8	-241	-8	-10	-17
50%	444	-166	-156	-143	0	-36	2	-118	-103	-20	-12	-14
60%	449	-75	-119	-50	-91	-52	483	-214	-36	-14	-13	-7
70%	494	-82	-48	-39	-139	-57	657	-192	-37	-15	-14	-4
80%	397	-33	-74	-40	-23	-43	347	-209	19	-1	-9	-1
90%	438	-30	-30	-34	2	-26	108	-213	0	-56	-5	-2
Long Term												
Full Simulation Period ^b	431	-110	-101	-66	-45	147	273	-61	-353	-3	9	-14
Water Year Types^c												
Wet (23%)	420	-114	-99	-60	13	555	49	195	-1,177	35	57	-40
Above Normal (24%)	412	-116	-94	-63	-65	121	282	-83	-244	-10	-2	-7
Below Normal (10%)	452	-148	-148	-102	-72	49	495	-74	-149	-18	-11	-19
Dry (16%)	428	-115	-115	-85	-79	-63	445	-171	-33	-12	-15	-13
Critical (27%)	452	-83	-83	-49	-48	-23	276	-194	-2	-17	1	2

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-34-5. San Joaquin River at Vernalis, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3,015	3,156	4,932	11,157	14,594	15,467	14,666	14,360	10,139	5,612	2,740	3,146
20%	2,692	2,843	2,953	4,819	10,200	9,482	10,169	8,291	5,696	2,636	2,600	2,658
30%	2,520	2,663	2,541	3,655	6,300	7,933	8,421	5,676	3,488	1,990	1,897	2,503
40%	2,331	2,500	2,341	2,692	4,268	5,393	7,435	4,617	3,188	1,742	1,676	2,142
50%	2,157	2,386	2,257	2,544	3,420	3,883	6,016	4,043	2,349	1,506	1,500	1,944
60%	1,952	2,244	2,165	2,343	2,774	3,511	4,349	3,276	1,895	1,379	1,415	1,842
70%	1,752	2,141	2,027	2,153	2,443	2,963	3,119	2,891	1,485	1,170	1,321	1,743
80%	1,597	1,984	1,903	1,923	2,174	2,414	2,442	2,362	1,274	1,088	1,211	1,611
90%	1,411	1,793	1,699	1,733	1,945	2,230	1,779	1,890	1,085	941	1,071	1,478
Long Term												
Full Simulation Period ^b	2,241	2,721	3,492	5,136	6,700	7,131	7,255	6,101	4,547	2,625	1,838	2,238
Water Year Types ^c												
Wet (23%)	2,497	3,627	6,644	11,506	15,763	16,308	15,374	14,433	12,512	6,641	3,078	3,456
Above Normal (24%)	2,288	2,532	2,757	4,947	6,946	7,415	8,260	5,348	3,525	1,999	1,977	2,352
Below Normal (10%)	2,086	2,397	3,810	3,608	3,723	4,101	5,842	4,213	2,225	1,481	1,457	1,856
Dry (16%)	2,339	2,684	2,347	2,487	2,628	3,304	3,551	2,976	1,714	1,267	1,362	1,789
Critical (27%)	1,974	2,251	1,998	1,927	2,138	2,311	2,031	2,122	1,116	943	1,059	1,485

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3,023	3,053	4,949	12,089	17,246	15,467	14,936	14,309	10,004	6,473	3,525	3,287
20%	2,667	2,830	2,938	4,833	10,213	9,874	10,251	7,931	4,627	2,495	2,587	2,623
30%	2,494	2,583	2,421	3,540	6,797	7,753	8,532	5,438	2,558	1,926	1,892	2,464
40%	2,328	2,478	2,304	2,753	4,210	5,305	7,580	4,344	2,294	1,722	1,667	2,125
50%	2,137	2,313	2,191	2,439	3,215	3,847	6,112	3,821	1,955	1,506	1,495	1,932
60%	1,956	2,244	2,140	2,236	2,668	3,440	4,501	2,907	1,700	1,361	1,415	1,838
70%	1,782	2,148	2,012	2,088	2,360	2,906	3,355	2,502	1,364	1,164	1,319	1,743
80%	1,609	1,974	1,886	1,824	2,090	2,371	2,581	2,158	1,241	1,026	1,211	1,612
90%	1,466	1,763	1,669	1,639	1,849	2,205	1,936	1,650	1,001	930	1,065	1,477
Long Term												
Full Simulation Period ^b	2,252	2,683	3,501	5,108	6,872	7,145	7,431	5,830	4,009	2,655	1,882	2,271
Water Year Types ^c												
Wet (23%)	2,505	3,604	6,760	11,512	16,584	16,445	15,425	14,237	11,476	6,916	3,267	3,610
Above Normal (24%)	2,310	2,488	2,775	4,925	6,937	7,444	8,476	5,078	2,579	1,910	1,972	2,341
Below Normal (10%)	2,067	2,299	3,711	3,708	3,857	4,057	6,015	3,856	1,865	1,472	1,454	1,834
Dry (16%)	2,346	2,646	2,309	2,419	2,607	3,241	3,785	2,611	1,568	1,253	1,360	1,782
Critical (27%)	1,991	2,227	1,974	1,842	2,043	2,273	2,247	1,874	1,080	912	1,067	1,497

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	8	-103	17	932	2,652	0	270	-51	-135	861	785	140
20%	-25	-12	-15	14	13	392	82	-360	-1,070	-142	-13	-34
30%	-26	-80	-120	-115	497	-180	111	-238	-930	-64	-5	-39
40%	-3	-22	-36	60	-58	-88	145	-273	-894	-20	-9	-17
50%	-20	-72	-65	-105	-205	-36	97	-222	-394	-1	-6	-11
60%	5	0	-25	-107	-107	-71	152	-369	-195	-19	0	-5
70%	30	7	-15	-65	-84	-57	237	-389	-121	-5	-2	-1
80%	12	-9	-17	-99	-84	-42	140	-203	-33	-62	0	1
90%	55	-30	-30	-94	-96	-25	156	-240	-84	-11	-6	-1
Long Term												
Full Simulation Period ^b	11	-38	9	-27	172	14	176	-271	-538	31	44	33
Water Year Types ^c												
Wet (23%)	8	-23	116	6	821	137	51	-197	-1,036	275	190	154
Above Normal (24%)	22	-45	18	-21	-9	29	216	-269	-945	-89	-5	-11
Below Normal (10%)	-19	-98	-98	100	134	-44	174	-357	-359	-9	-4	-22
Dry (16%)	7	-38	-38	-68	-21	-62	233	-365	-146	-14	-2	-7
Critical (27%)	16	-24	-24	-84	-95	-38	215	-248	-36	-31	8	12

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-34-6. San Joaquin River at Vernalis, Monthly Flow

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance^a												
10%	3,015	3,156	4,932	11,157	14,594	15,467	14,666	14,360	10,139	5,612	2,740	3,146
20%	2,692	2,843	2,953	4,819	10,200	9,482	10,169	8,291	5,696	2,636	2,600	2,658
30%	2,520	2,663	2,541	3,655	6,300	7,933	8,421	5,676	3,488	1,990	1,897	2,503
40%	2,331	2,500	2,341	2,692	4,268	5,393	7,435	4,617	3,188	1,742	1,676	2,142
50%	2,157	2,386	2,257	2,544	3,420	3,883	6,016	4,043	2,349	1,506	1,500	1,944
60%	1,952	2,244	2,165	2,343	2,774	3,511	4,349	3,276	1,895	1,379	1,415	1,842
70%	1,752	2,141	2,027	2,153	2,443	2,963	3,119	2,891	1,485	1,170	1,321	1,743
80%	1,597	1,984	1,903	1,923	2,174	2,414	2,442	2,362	1,274	1,088	1,211	1,611
90%	1,411	1,793	1,699	1,733	1,945	2,230	1,779	1,890	1,085	941	1,071	1,478
Long Term												
Full Simulation Period ^b	2,241	2,721	3,492	5,136	6,700	7,131	7,255	6,101	4,547	2,625	1,838	2,238
Water Year Types^c												
Wet (23%)	2,497	3,627	6,644	11,506	15,763	16,308	15,374	14,433	12,512	6,641	3,078	3,456
Above Normal (24%)	2,288	2,532	2,757	4,947	6,946	7,415	8,260	5,348	3,525	1,999	1,977	2,352
Below Normal (10%)	2,086	2,397	3,810	3,608	3,723	4,101	5,842	4,213	2,225	1,481	1,457	1,856
Dry (16%)	2,339	2,684	2,347	2,487	2,628	3,304	3,551	2,976	1,714	1,267	1,362	1,789
Critical (27%)	1,974	2,251	1,998	1,927	2,138	2,311	2,031	2,122	1,116	943	1,059	1,485

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,495	2,953	4,804	11,129	14,597	15,473	14,976	14,176	9,351	5,773	2,776	3,084
20%	3,146	2,777	2,897	4,811	10,142	9,856	10,265	8,232	4,688	2,628	2,589	2,654
30%	2,938	2,527	2,401	3,610	6,118	8,461	8,576	5,670	3,364	1,985	1,904	2,488
40%	2,763	2,395	2,204	2,629	4,232	5,570	7,567	5,162	2,947	1,735	1,666	2,125
50%	2,588	2,219	2,101	2,402	3,420	3,846	6,110	4,183	2,219	1,484	1,488	1,930
60%	2,385	2,169	2,046	2,289	2,683	3,459	5,047	3,554	1,860	1,365	1,402	1,835
70%	2,196	2,059	1,979	2,083	2,303	2,906	4,317	2,916	1,447	1,155	1,307	1,739
80%	1,988	1,951	1,829	1,883	2,145	2,371	3,100	2,401	1,283	1,052	1,202	1,611
90%	1,849	1,763	1,669	1,699	1,947	2,204	2,461	2,245	1,000	885	1,025	1,431
Long Term												
Full Simulation Period ^b	2,660	2,609	3,371	5,071	6,639	7,235	7,686	6,290	4,174	2,597	1,818	2,213
Water Year Types^c												
Wet (23%)	2,903	3,513	6,448	11,445	15,743	16,679	15,389	14,666	11,287	6,580	3,020	3,379
Above Normal (24%)	2,691	2,411	2,679	4,897	6,864	7,536	8,487	5,671	3,280	1,989	1,975	2,345
Below Normal (10%)	2,531	2,249	3,661	3,506	3,650	4,149	6,299	4,206	2,062	1,462	1,446	1,837
Dry (16%)	2,750	2,569	2,232	2,400	2,547	3,241	4,420	3,245	1,672	1,253	1,346	1,776
Critical (27%)	2,418	2,163	1,910	1,871	2,078	2,288	2,741	2,177	1,090	916	1,051	1,480

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	480	-204	-128	-28	3	6	310	-184	-788	161	37	-62
20%	454	-65	-56	-8	-57	373	95	-60	-1,008	-8	-10	-3
30%	418	-136	-141	-44	-182	527	155	-6	-124	-4	7	-14
40%	432	-105	-137	-64	-36	176	131	545	-241	-8	-9	-18
50%	430	-166	-156	-143	0	-36	94	140	-129	-22	-12	-14
60%	433	-75	-119	-54	-91	-52	697	278	-35	-14	-13	-7
70%	444	-82	-48	-69	-141	-57	1,198	24	-37	-15	-14	-4
80%	390	-33	-74	-40	-29	-43	659	39	9	-37	-9	-1
90%	438	-30	-30	-34	2	-26	682	355	-85	-56	-46	-47
Long Term												
Full Simulation Period ^b	420	-112	-121	-65	-61	104	431	189	-373	-28	-20	-25
Water Year Types^c												
Wet (23%)	406	-114	-196	-60	-20	371	14	233	-1,224	-61	-58	-77
Above Normal (24%)	403	-121	-79	-50	-82	121	227	323	-244	-10	-3	-7
Below Normal (10%)	444	-148	-148	-102	-73	48	457	-8	-162	-18	-12	-19
Dry (16%)	411	-115	-115	-86	-81	-63	869	269	-42	-13	-15	-14
Critical (27%)	443	-88	-88	-55	-61	-23	710	54	-26	-27	-8	-5

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

1 **C.35. Stanislaus River Flow below Goodwin**


Figure C-35-1. Stanislaus River below Goodwin, Long-Term* Average Flow

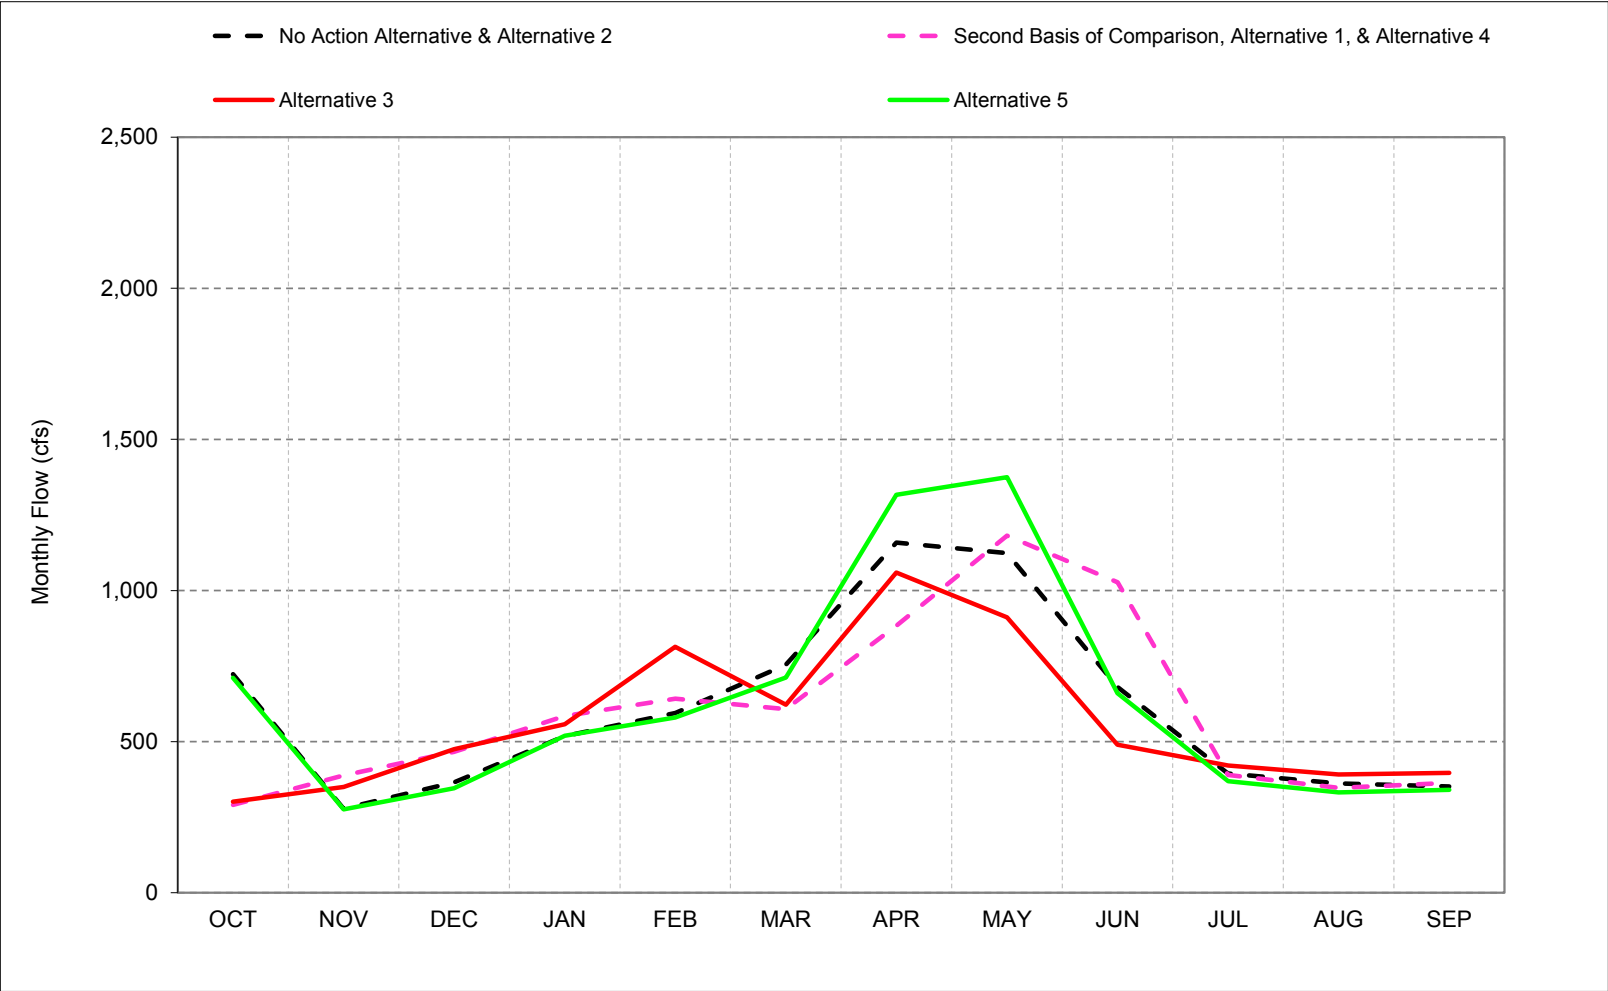

*Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-35-2. Stanislaus River below Goodwin, Wet Year* Long-Term** Average Flow

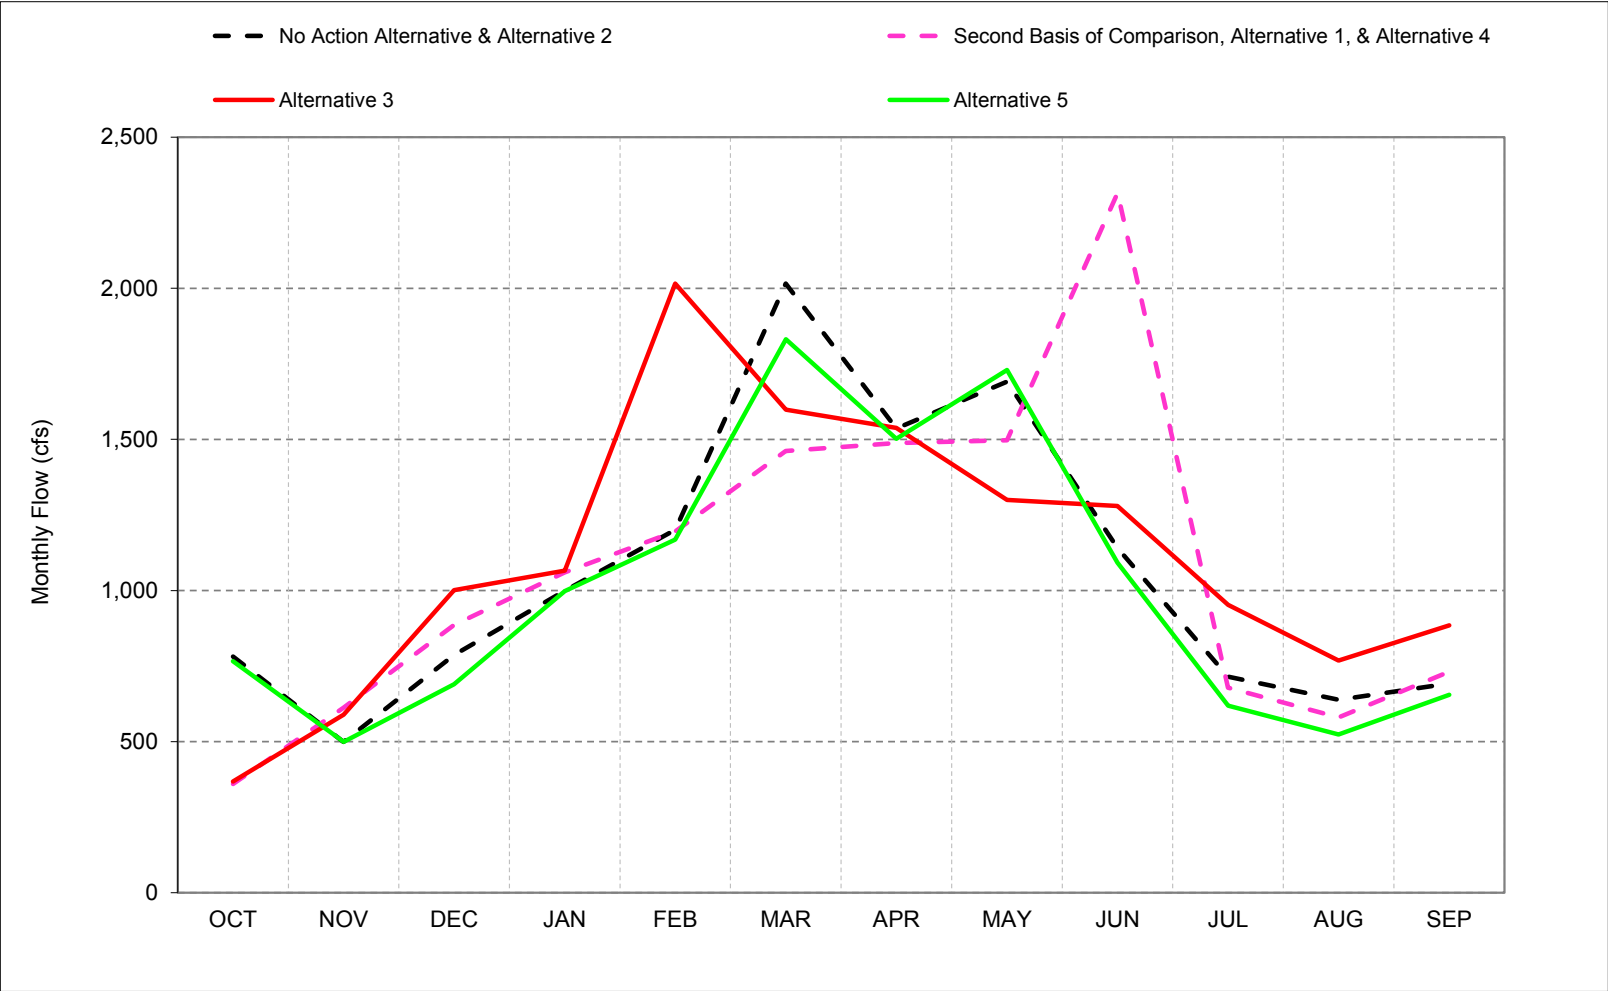


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-35-3. Stanislaus River below Goodwin, Above Normal Year* Long-Term** Average Flow

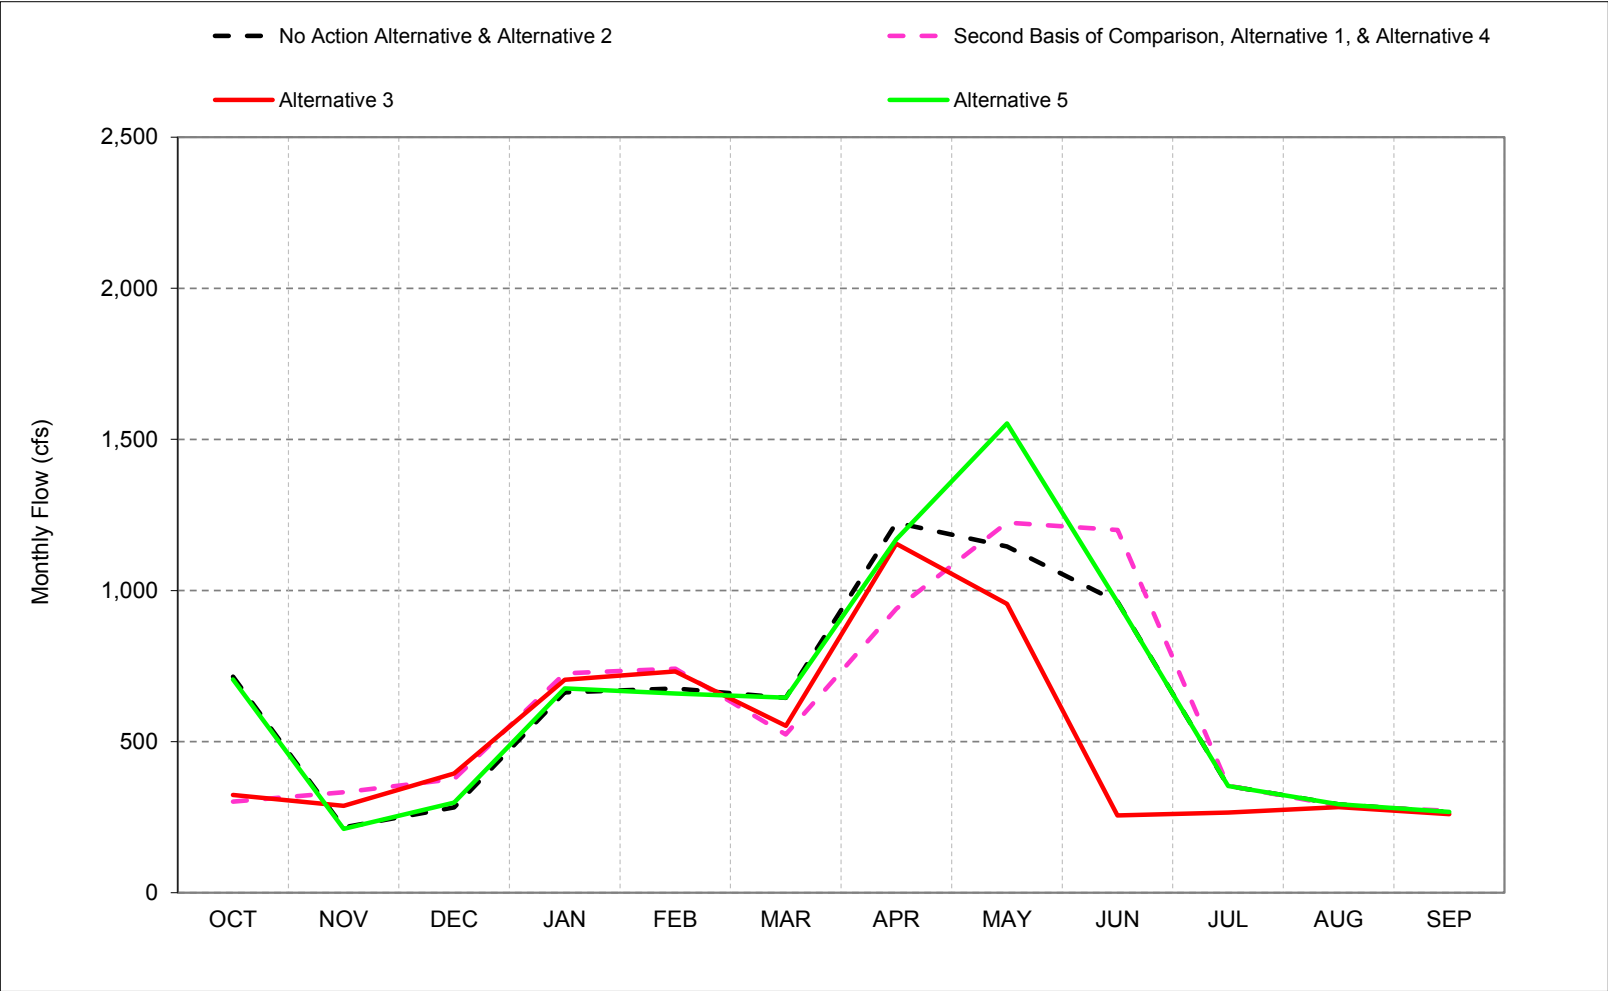


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-35-4. Stanislaus River below Goodwin, Below Normal Year* Long-Term** Average Flow

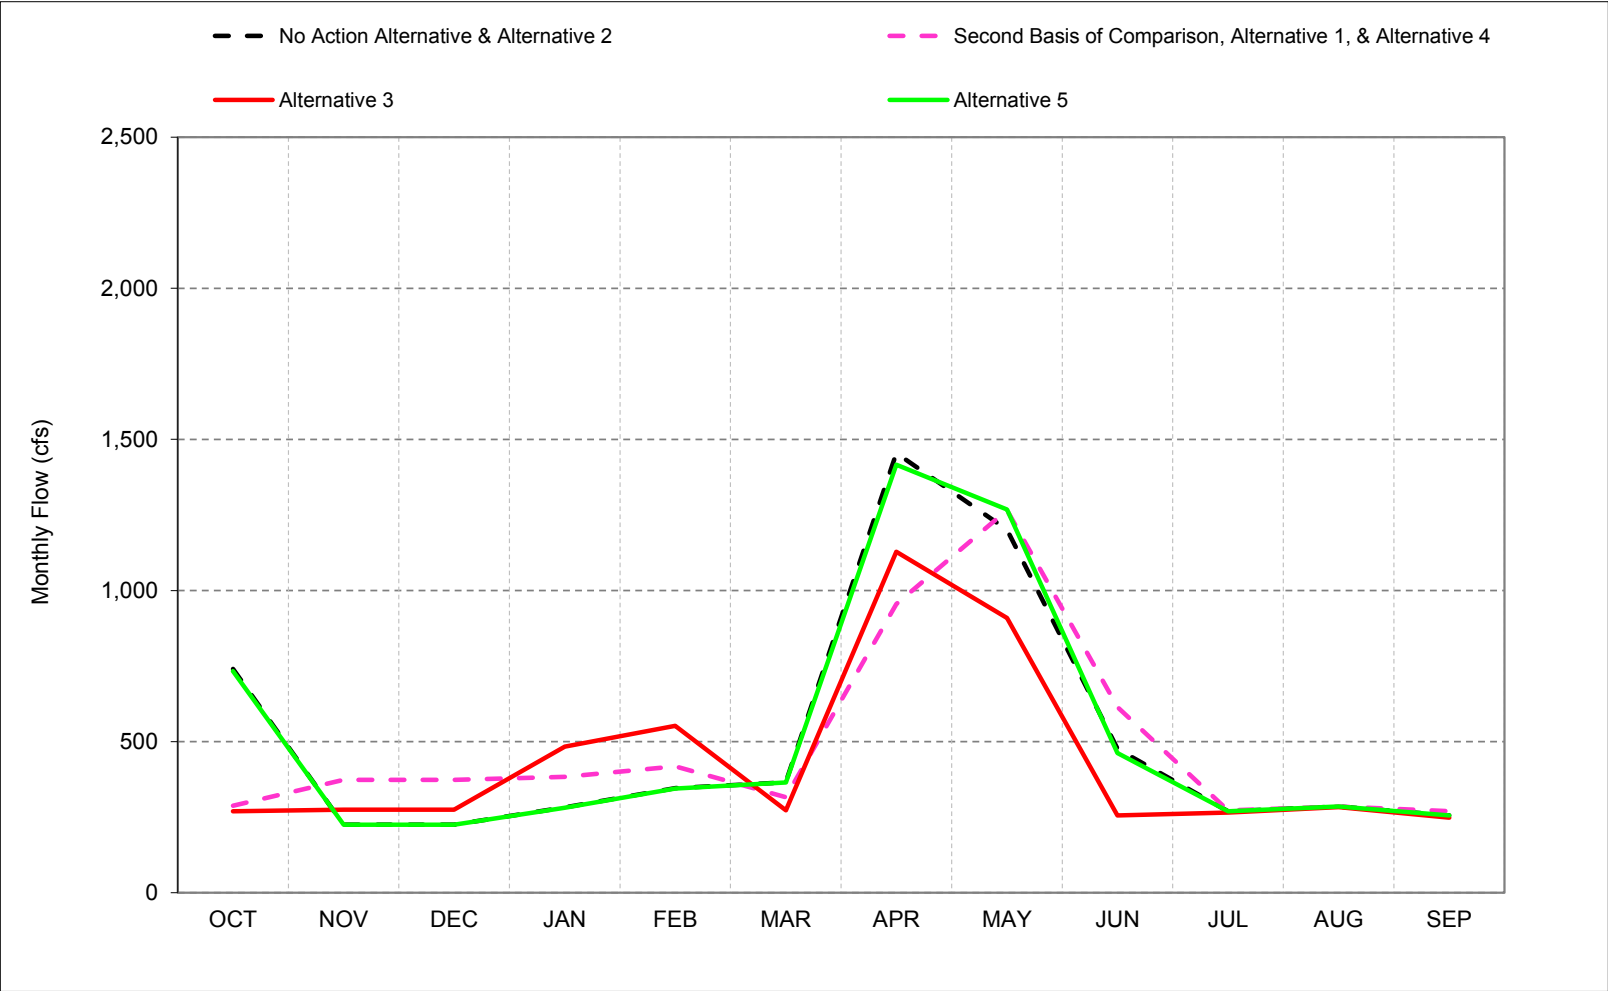


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-35-5. Stanislaus River below Goodwin, Dry Year* Long-Term** Average Flow

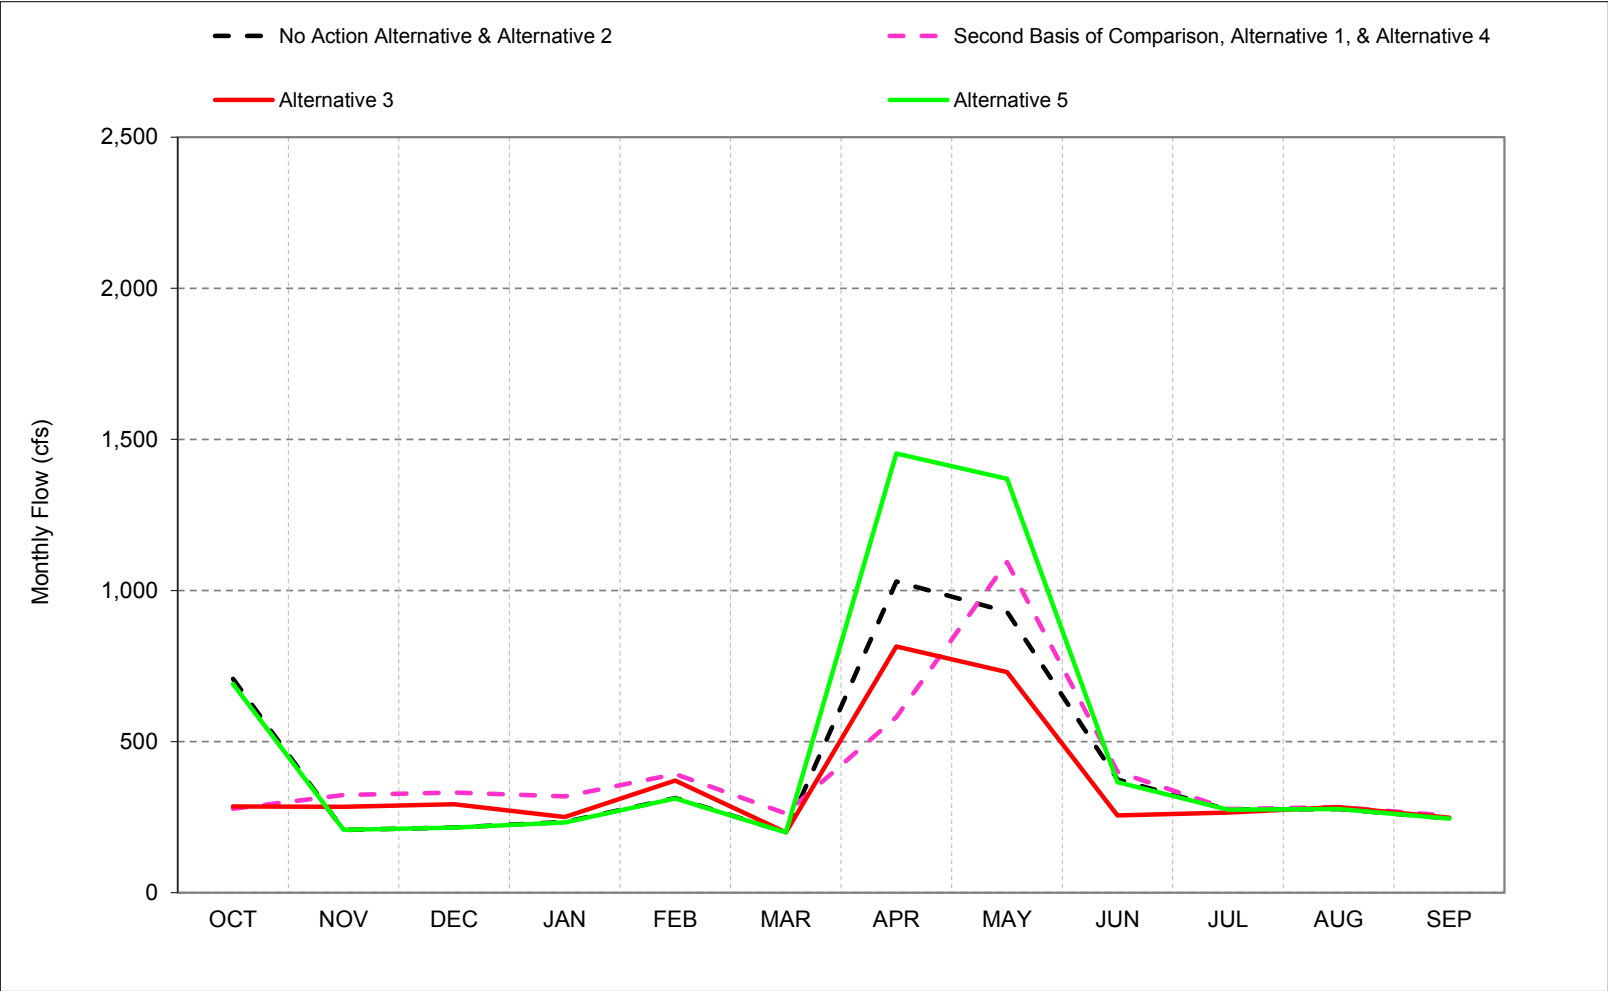


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-35-6. Stanislaus River below Goodwin, Critical Year* Long-Term** Average Flow

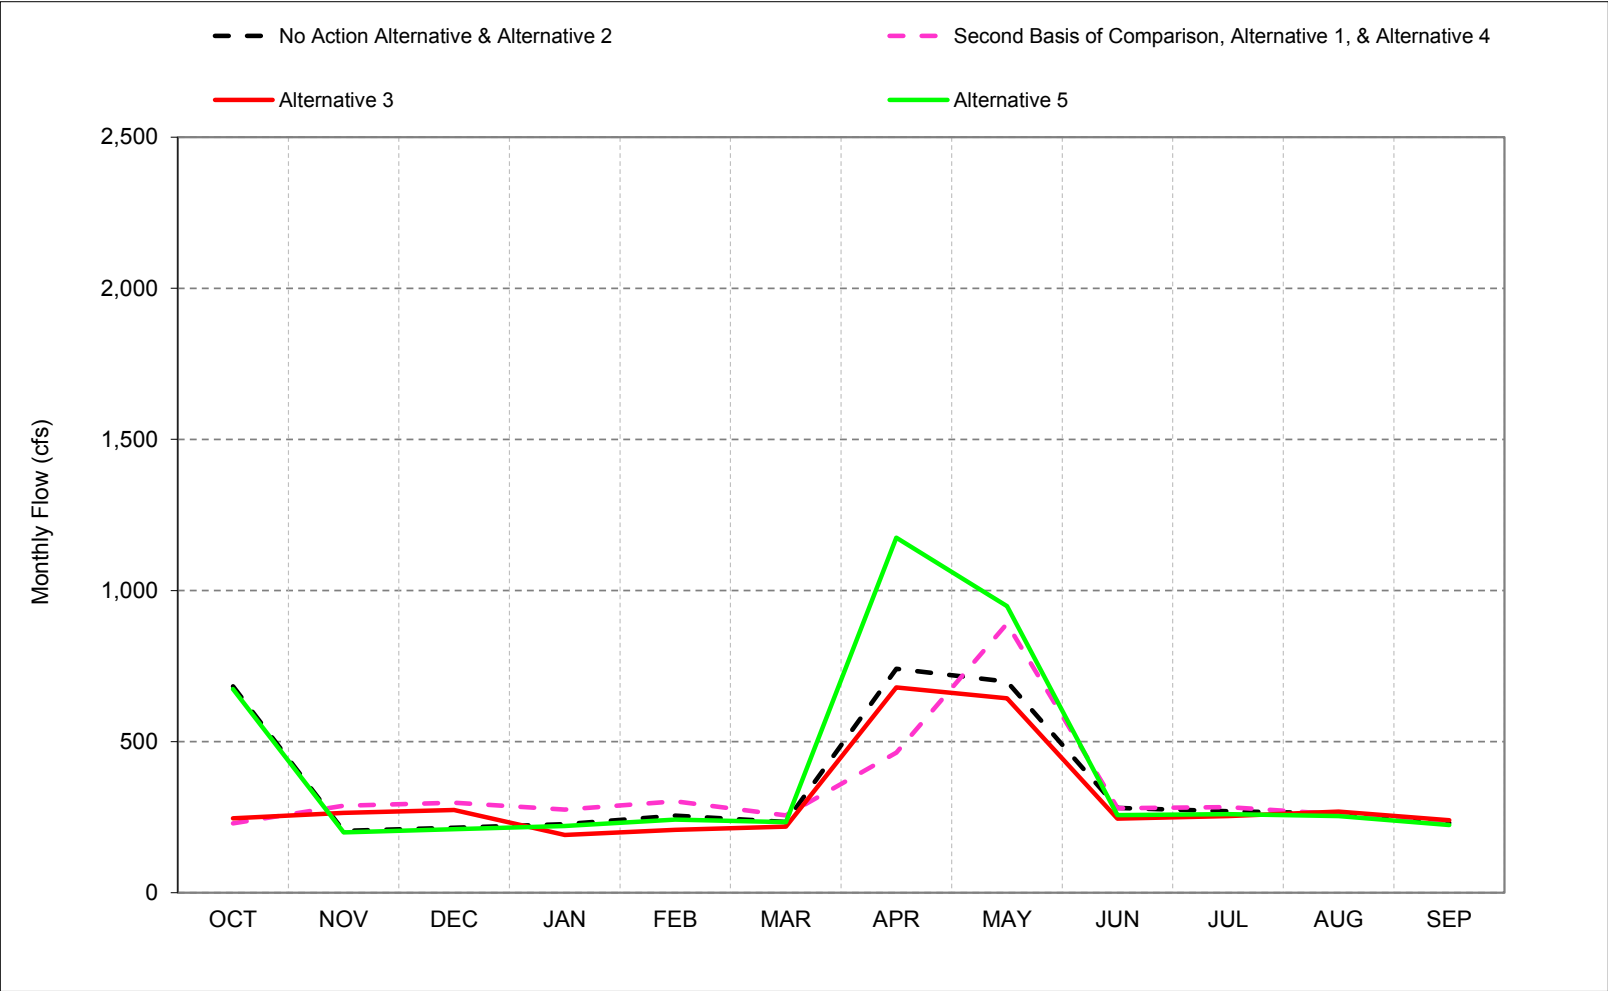

*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-35-1. Stanislaus River below Goodwin, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	837	290	306	358	897	1,648	1,633	1,929	1,103	429	390	390
20%	797	200	218	232	409	1,521	1,553	1,555	1,090	310	300	300
30%	774	200	200	232	290	440	1,553	1,296	940	300	284	250
40%	774	200	200	226	236	200	1,400	1,242	855	300	283	250
50%	774	200	200	226	236	200	1,400	1,242	363	271	283	250
60%	636	200	200	219	229	200	812	918	363	265	283	249
70%	636	200	200	219	229	200	767	705	297	265	283	249
80%	578	200	200	214	221	200	767	631	261	265	283	249
90%	577	200	200	213	215	200	505	546	255	265	283	249
Long Term												
Full Simulation Period ^b	723	278	365	518	595	754	1,158	1,123	680	394	361	351
Water Year Types ^c												
Wet (23%)	781	499	787	999	1,201	2,016	1,536	1,691	1,140	715	639	692
Above Normal (24%)	714	216	282	663	676	645	1,224	1,146	962	353	292	267
Below Normal (10%)	740	225	225	282	346	365	1,454	1,201	476	269	285	256
Dry (16%)	707	208	216	234	313	200	1,030	930	374	275	277	245
Critical (27%)	683	205	215	227	255	234	741	699	281	269	262	231

Alternative 1												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	350	499	508	508	907	709	1,500	1,500	2,887	360	300	300
20%	350	415	415	415	503	415	1,462	1,500	1,709	306	300	300
30%	331	386	415	408	415	415	1,337	1,434	1,571	300	296	268
40%	286	318	326	318	415	318	991	1,303	845	300	283	268
50%	286	318	318	318	318	318	664	1,303	450	284	283	268
60%	194	247	275	242	318	275	512	1,112	398	268	283	249
70%	194	247	247	242	260	242	461	920	289	268	283	249
80%	173	233	247	242	242	242	424	848	257	265	283	249
90%	164	230	230	200	239	200	378	760	255	265	283	249
Long Term												
Full Simulation Period ^b	291	388	466	584	642	607	884	1,181	1,028	390	347	363
Water Year Types ^c												
Wet (23%)	360	612	886	1,060	1,196	1,462	1,488	1,497	2,316	678	580	731
Above Normal (24%)	301	332	376	726	742	523	940	1,225	1,200	354	288	271
Below Normal (10%)	288	373	373	383	418	316	955	1,266	613	272	285	270
Dry (16%)	278	323	331	318	392	262	581	1,094	399	276	283	255
Critical (27%)	230	287	298	275	303	256	464	890	280	283	259	228

Alternative 1 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-487	209	203	150	10	-939	-133	-429	1,783	-69	-90	-90
20%	-447	215	197	183	94	-1,106	-91	-55	619	-4	0	0
30%	-443	186	215	176	125	-25	-216	138	631	0	12	18
40%	-488	118	126	92	179	118	-409	61	-10	0	0	18
50%	-488	118	118	92	83	118	-736	61	87	13	0	18
60%	-441	47	75	23	90	75	-300	194	35	3	0	0
70%	-441	47	47	23	31	42	-306	215	-8	3	0	0
80%	-405	33	47	28	21	42	-343	218	-4	0	0	0
90%	-413	30	30	-13	24	0	-127	214	0	0	0	0
Long Term												
Full Simulation Period ^b	-432	110	101	66	47	-147	-275	58	348	-4	-15	12
Water Year Types ^c												
Wet (23%)	-421	113	99	61	-5	-554	-48	-195	1,176	-37	-59	39
Above Normal (24%)	-413	116	94	63	66	-122	-284	79	238	1	-4	4
Below Normal (10%)	-453	148	148	101	72	-50	-500	65	138	2	0	14
Dry (16%)	-429	115	115	84	79	62	-449	164	25	1	6	9
Critical (27%)	-453	83	83	49	47	23	-277	192	-1	14	-3	-3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-35-2. Stanislaus River below Goodwin, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	837	290	306	358	897	1,648	1,633	1,929	1,103	429	390	390
20%	797	200	218	232	409	1,521	1,553	1,555	1,090	310	300	300
30%	774	200	200	232	290	440	1,553	1,296	940	300	284	250
40%	774	200	200	226	236	200	1,400	1,242	855	300	283	250
50%	774	200	200	226	236	200	1,400	1,242	363	271	283	250
60%	636	200	200	219	229	200	812	918	363	265	283	249
70%	636	200	200	219	229	200	767	705	297	265	283	249
80%	578	200	200	214	221	200	767	631	261	265	283	249
90%	577	200	200	213	215	200	505	546	255	265	283	249
Long Term												
Full Simulation Period ^b	723	278	365	518	595	754	1,158	1,123	680	394	361	351
Water Year Types^c												
Wet (23%)	781	499	787	999	1,201	2,016	1,536	1,691	1,140	715	639	692
Above Normal (24%)	714	216	282	663	676	645	1,224	1,146	962	353	292	267
Below Normal (10%)	740	225	225	282	346	365	1,454	1,201	476	269	285	256
Dry (16%)	707	208	216	234	313	200	1,030	930	374	275	277	245
Critical (27%)	683	205	215	227	255	234	741	699	281	269	262	231

Alternative 3												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	300	300	609	1,135	2,548	1,189	1,500	1,165	255	265	283	952
20%	300	300	305	300	1,157	344	1,500	1,165	255	265	283	249
30%	300	300	300	300	333	300	1,500	1,165	255	265	283	249
40%	252	300	300	300	300	300	1,034	963	255	265	283	249
50%	252	300	300	150	176	200	893	829	255	265	283	249
60%	252	300	300	150	173	200	893	829	255	265	283	249
70%	252	300	300	150	173	200	893	829	255	265	283	249
80%	200	200	220	150	173	200	528	466	255	265	283	249
90%	200	200	200	150	173	200	493	466	255	265	283	249
Long Term												
Full Simulation Period ^b	302	349	475	557	814	622	1,060	911	490	421	391	397
Water Year Types^c												
Wet (23%)	368	589	1,001	1,066	2,016	1,599	1,538	1,300	1,279	952	768	885
Above Normal (24%)	323	287	394	705	732	552	1,155	955	255	265	283	260
Below Normal (10%)	269	275	275	483	552	272	1,128	909	255	265	283	249
Dry (16%)	285	285	293	251	371	200	815	730	255	265	283	249
Critical (27%)	246	264	274	191	208	218	680	643	245	254	268	240

Alternative 3 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-537	10	303	776	1,651	-460	-133	-765	-848	-164	-107	562
20%	-497	100	86	68	748	-1,177	-53	-390	-835	-45	-17	-51
30%	-474	100	100	68	43	-140	-53	-131	-685	-35	-1	-1
40%	-522	100	100	74	64	100	-366	-279	-599	-35	0	-1
50%	-522	100	100	-76	-59	0	-507	-413	-108	-5	0	-1
60%	-384	100	100	-69	-56	0	81	-89	-108	0	0	0
70%	-384	100	100	-69	-56	0	127	124	-42	0	0	0
80%	-378	0	20	-64	-48	0	-238	-165	-5	0	0	0
90%	-377	0	0	-63	-42	0	-12	-79	0	0	0	0
Long Term												
Full Simulation Period ^b	-421	71	110	39	219	-132	-99	-212	-190	27	30	45
Water Year Types^c												
Wet (23%)	-413	90	215	67	815	-417	2	-392	139	237	130	193
Above Normal (24%)	-391	71	112	42	57	-93	-69	-191	-707	-88	-9	-7
Below Normal (10%)	-471	50	50	201	206	-93	-327	-292	-220	-4	-2	-7
Dry (16%)	-422	77	77	16	58	0	-215	-199	-119	-10	6	3
Critical (27%)	-436	59	59	-36	-47	-15	-61	-56	-35	-15	6	9

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-35-3. Stanislaus River below Goodwin, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	837	290	306	358	897	1,648	1,633	1,929	1,103	429	390	390
20%	797	200	218	232	409	1,521	1,553	1,555	1,090	310	300	300
30%	774	200	200	232	290	440	1,553	1,296	940	300	284	250
40%	774	200	200	226	236	200	1,400	1,242	855	300	283	250
50%	774	200	200	226	236	200	1,400	1,242	363	271	283	250
60%	636	200	200	219	229	200	812	918	363	265	283	249
70%	636	200	200	219	229	200	767	705	297	265	283	249
80%	578	200	200	214	221	200	767	631	261	265	283	249
90%	577	200	200	213	215	200	505	546	255	265	283	249
Long Term												
Full Simulation Period ^b	723	278	365	518	595	754	1,158	1,123	680	394	361	351
Water Year Types^c												
Wet (23%)	781	499	787	999	1,201	2,016	1,536	1,691	1,140	715	639	692
Above Normal (24%)	714	216	282	663	676	645	1,224	1,146	962	353	292	267
Below Normal (10%)	740	225	225	282	346	365	1,454	1,201	476	269	285	256
Dry (16%)	707	208	216	234	313	200	1,030	930	374	275	277	245
Critical (27%)	683	205	215	227	255	234	741	699	281	269	262	231

Alternative 5												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	797	200	306	358	885	1,636	1,717	1,958	1,103	423	300	300
20%	797	200	211	232	415	1,521	1,633	1,815	979	307	300	300
30%	774	200	200	232	274	343	1,553	1,595	940	300	283	250
40%	774	200	200	226	236	200	1,487	1,555	759	297	283	250
50%	636	200	200	226	236	200	1,400	1,341	363	265	283	249
60%	636	200	200	219	229	200	1,324	1,242	342	265	283	249
70%	636	200	200	219	222	200	1,134	1,068	270	265	283	249
80%	577	200	200	213	221	200	825	887	255	265	283	249
90%	577	200	200	213	214	200	767	798	255	265	283	249
Long Term												
Full Simulation Period ^b	711	276	345	520	580	712	1,317	1,375	660	369	332	341
Water Year Types^c												
Wet (23%)	766	499	690	998	1,169	1,831	1,502	1,730	1,093	619	523	655
Above Normal (24%)	705	211	298	676	659	645	1,170	1,553	962	353	292	267
Below Normal (10%)	733	225	225	281	345	365	1,416	1,267	462	269	285	256
Dry (16%)	690	208	216	233	312	200	1,454	1,370	366	275	277	245
Critical (27%)	674	200	210	221	242	234	1,175	948	257	260	253	224

Alternative 5 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-41	-90	0	0	-12	-13	83	29	0	-6	-90	-90
20%	0	0	-7	0	6	0	80	261	-111	-3	0	0
30%	0	0	0	0	-15	-97	0	299	0	0	-1	0
40%	0	0	0	0	0	0	87	313	-96	-3	0	0
50%	-139	0	0	0	0	0	0	99	0	-5	0	-1
60%	0	0	0	0	0	0	512	324	-21	0	0	0
70%	0	0	0	0	-6	0	367	363	-27	0	0	0
80%	-1	0	0	-1	0	0	59	256	-5	0	0	0
90%	0	0	0	0	-1	0	262	252	0	0	0	0
Long Term												
Full Simulation Period ^b	-11	-2	-20	1	-15	-43	159	251	-20	-25	-29	-11
Water Year Types^c												
Wet (23%)	-15	0	-97	0	-33	-185	-34	38	-47	-96	-115	-38
Above Normal (24%)	-9	-5	16	13	-17	0	-55	407	0	0	0	0
Below Normal (10%)	-7	0	0	-1	-1	0	-38	66	-13	0	0	0
Dry (16%)	-17	0	0	-1	-2	0	424	440	-8	0	0	0
Critical (27%)	-8	-5	-5	-6	-13	0	434	250	-24	-10	-9	-7

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-35-4. Stanislaus River below Goodwin, Monthly Flow

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	350	499	508	508	907	709	1,500	1,500	2,887	360	300	300
20%	350	415	415	415	503	415	1,462	1,500	1,709	306	300	300
30%	331	386	415	408	415	415	1,337	1,434	1,571	300	296	268
40%	286	318	326	318	415	318	991	1,303	845	300	283	268
50%	286	318	318	318	318	318	664	1,303	450	284	283	268
60%	194	247	275	242	318	275	512	1,112	398	268	283	249
70%	194	247	247	242	260	242	461	920	289	268	283	249
80%	173	233	247	242	242	242	424	848	257	265	283	249
90%	164	230	230	200	239	200	378	760	255	265	283	249
Long Term												
Full Simulation Period ^b	291	388	466	584	642	607	884	1,181	1,028	390	347	363
Water Year Types ^c												
Wet (23%)	360	612	886	1,060	1,196	1,462	1,488	1,497	2,316	678	580	731
Above Normal (24%)	301	332	376	726	742	523	940	1,225	1,200	354	288	271
Below Normal (10%)	288	373	373	383	418	316	955	1,266	613	272	285	270
Dry (16%)	278	323	331	318	392	262	581	1,094	399	276	283	255
Critical (27%)	230	287	298	275	303	256	464	890	280	283	259	228

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance ^a												
10%	837	290	306	358	897	1,648	1,633	1,929	1,103	429	390	390
20%	797	200	218	232	409	1,521	1,553	1,555	1,090	310	300	300
30%	774	200	200	232	290	440	1,553	1,296	940	300	284	250
40%	774	200	200	226	236	200	1,400	1,242	855	300	283	250
50%	774	200	200	226	236	200	1,400	1,242	363	271	283	250
60%	636	200	200	219	229	200	812	918	363	265	283	249
70%	636	200	200	219	229	200	767	705	297	265	283	249
80%	578	200	200	214	221	200	767	631	261	265	283	249
90%	577	200	200	213	215	200	505	546	255	265	283	249
Long Term												
Full Simulation Period ^b	723	278	365	518	595	754	1,158	1,123	680	394	361	351
Water Year Types ^c												
Wet (23%)	781	499	787	999	1,201	2,016	1,536	1,691	1,140	715	639	692
Above Normal (24%)	714	216	282	663	676	645	1,224	1,146	962	353	292	267
Below Normal (10%)	740	225	225	282	346	365	1,454	1,201	476	269	285	256
Dry (16%)	707	208	216	234	313	200	1,030	930	374	275	277	245
Critical (27%)	683	205	215	227	255	234	741	699	281	269	262	231

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative minus Second Basis of Comparison												
Probability of Exceedance ^a												
10%	487	-209	-203	-150	-10	939	133	429	-1,783	69	90	90
20%	447	-215	-197	-183	-94	1,106	91	55	-619	4	0	0
30%	443	-186	-215	-176	-125	25	216	-138	-631	0	-12	-18
40%	488	-118	-126	-92	-179	-118	409	-61	10	0	0	-18
50%	488	-118	-118	-92	-83	-118	736	-61	-87	-13	0	-18
60%	441	-47	-75	-23	-90	-75	300	-194	-35	-3	0	0
70%	441	-47	-47	-23	-31	-42	306	-215	8	-3	0	0
80%	405	-33	-47	-28	-21	-42	343	-218	4	0	0	0
90%	413	-30	-30	13	-24	0	127	-214	0	0	0	0
Long Term												
Full Simulation Period ^b	432	-110	-101	-66	-47	147	275	-58	-348	4	15	-12
Water Year Types ^c												
Wet (23%)	421	-113	-99	-61	5	554	48	195	-1,176	37	59	-39
Above Normal (24%)	413	-116	-94	-63	-66	122	284	-79	-238	-1	4	-4
Below Normal (10%)	453	-148	-148	-101	-72	50	500	-65	-138	-2	0	-14
Dry (16%)	429	-115	-115	-84	-79	-62	449	-164	-25	-1	-6	-9
Critical (27%)	453	-83	-83	-49	-47	-23	277	-192	1	-14	3	3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-35-5. Stanislaus River below Goodwin, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	350	499	508	508	907	709	1,500	1,500	2,887	360	300	300
20%	350	415	415	415	503	415	1,462	1,500	1,709	306	300	300
30%	331	386	415	408	415	415	1,337	1,434	1,571	300	296	268
40%	286	318	326	318	415	318	991	1,303	845	300	283	268
50%	286	318	318	318	318	318	664	1,303	450	284	283	268
60%	194	247	275	242	318	275	512	1,112	398	268	283	249
70%	194	247	247	242	260	242	461	920	289	268	283	249
80%	173	233	247	242	242	242	424	848	257	265	283	249
90%	164	230	230	200	239	200	378	760	255	265	283	249
Long Term												
Full Simulation Period ^b	291	388	466	584	642	607	884	1,181	1,028	390	347	363
Water Year Types ^c												
Wet (23%)	360	612	886	1,060	1,196	1,462	1,488	1,497	2,316	678	580	731
Above Normal (24%)	301	332	376	726	742	523	940	1,225	1,200	354	288	271
Below Normal (10%)	288	373	373	383	418	316	955	1,266	613	272	285	270
Dry (16%)	278	323	331	318	392	262	581	1,094	399	276	283	255
Critical (27%)	230	287	298	275	303	256	464	890	280	283	259	228

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	300	300	609	1,135	2,548	1,189	1,500	1,165	255	265	283	952
20%	300	300	305	300	1,157	344	1,500	1,165	255	265	283	249
30%	300	300	300	300	333	300	1,500	1,165	255	265	283	249
40%	252	300	300	300	300	300	1,034	963	255	265	283	249
50%	252	300	300	150	176	200	893	829	255	265	283	249
60%	252	300	300	150	173	200	893	829	255	265	283	249
70%	252	300	300	150	173	200	893	829	255	265	283	249
80%	200	200	220	150	173	200	528	466	255	265	283	249
90%	200	200	200	150	173	200	493	466	255	265	283	249
Long Term												
Full Simulation Period ^b	302	349	475	557	814	622	1,060	911	490	421	391	397
Water Year Types ^c												
Wet (23%)	368	589	1,001	1,066	2,016	1,599	1,538	1,300	1,279	952	768	885
Above Normal (24%)	323	287	394	705	732	552	1,155	955	255	265	283	260
Below Normal (10%)	269	275	275	483	552	272	1,128	909	255	265	283	249
Dry (16%)	285	285	293	251	371	200	815	730	255	265	283	249
Critical (27%)	246	264	274	191	208	218	680	643	245	254	268	240

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-50	-199	100	626	1,641	479	0	-335	-2,631	-94	-17	652
20%	-50	-115	-110	-115	654	-71	38	-335	-1,454	-41	-17	-51
30%	-31	-86	-115	-108	-82	-115	163	-269	-1,316	-35	-13	-19
40%	-34	-18	-26	-18	-115	-18	43	-340	-590	-35	0	-19
50%	-34	-18	-18	-168	-142	-118	229	-474	-195	-19	0	-19
60%	58	53	25	-92	-145	-75	381	-283	-143	-3	0	0
70%	58	53	53	-92	-87	-42	432	-91	-34	-3	0	0
80%	27	-33	-27	-92	-69	-42	104	-382	-1	0	0	0
90%	36	-30	-30	-50	-66	0	116	-294	0	0	0	0
Long Term												
Full Simulation Period ^b	11	-38	9	-27	172	15	176	-270	-538	32	45	33
Water Year Types ^c												
Wet (23%)	8	-23	116	6	820	137	50	-197	-1,037	274	189	154
Above Normal (24%)	22	-45	18	-21	-9	29	215	-269	-945	-89	-5	-11
Below Normal (10%)	-19	-98	-98	100	134	-43	173	-356	-358	-7	-2	-21
Dry (16%)	7	-38	-38	-68	-21	-62	234	-364	-144	-11	0	-6
Critical (27%)	17	-24	-24	-84	-95	-38	216	-247	-35	-29	9	12

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-35-6. Stanislaus River below Goodwin, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	350	499	508	508	907	709	1,500	1,500	2,887	360	300	300
20%	350	415	415	415	503	415	1,462	1,500	1,709	306	300	300
30%	331	386	415	408	415	415	1,337	1,434	1,571	300	296	268
40%	286	318	326	318	415	318	991	1,303	845	300	283	268
50%	286	318	318	318	318	318	664	1,303	450	284	283	268
60%	194	247	275	242	318	275	512	1,112	398	268	283	249
70%	194	247	247	242	260	242	461	920	289	268	283	249
80%	173	233	247	242	242	242	424	848	257	265	283	249
90%	164	230	230	200	239	200	378	760	255	265	283	249
Long Term												
Full Simulation Period ^b	291	388	466	584	642	607	884	1,181	1,028	390	347	363
Water Year Types ^c												
Wet (23%)	360	612	886	1,060	1,196	1,462	1,488	1,497	2,316	678	580	731
Above Normal (24%)	301	332	376	726	742	523	940	1,225	1,200	354	288	271
Below Normal (10%)	288	373	373	383	418	316	955	1,266	613	272	285	270
Dry (16%)	278	323	331	318	392	262	581	1,094	399	276	283	255
Critical (27%)	230	287	298	275	303	256	464	890	280	283	259	228

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	797	200	306	358	885	1,636	1,717	1,958	1,103	423	300	300
20%	797	200	211	232	415	1,521	1,633	1,815	979	307	300	300
30%	774	200	200	232	274	343	1,553	1,595	940	300	283	250
40%	774	200	200	226	236	200	1,487	1,555	759	297	283	250
50%	636	200	200	226	236	200	1,400	1,341	363	265	283	249
60%	636	200	200	219	229	200	1,324	1,242	342	265	283	249
70%	636	200	200	219	222	200	1,134	1,068	270	265	283	249
80%	577	200	200	213	221	200	825	887	255	265	283	249
90%	577	200	200	213	214	200	767	798	255	265	283	249
Long Term												
Full Simulation Period ^b	711	276	345	520	580	712	1,317	1,375	660	369	332	341
Water Year Types ^c												
Wet (23%)	766	499	690	998	1,169	1,831	1,502	1,730	1,093	619	523	655
Above Normal (24%)	705	211	298	676	659	645	1,170	1,553	962	353	292	267
Below Normal (10%)	733	225	225	281	345	365	1,416	1,267	462	269	285	256
Dry (16%)	690	208	216	233	312	200	1,454	1,370	366	275	277	245
Critical (27%)	674	200	210	221	242	234	1,175	948	257	260	253	224

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	447	-299	-203	-150	-22	926	217	458	-1,783	63	0	0
20%	447	-215	-204	-183	-88	1,106	171	315	-730	1	0	0
30%	443	-186	-215	-176	-141	-72	216	161	-631	0	-13	-18
40%	488	-118	-126	-92	-179	-118	496	252	-86	-3	0	-18
50%	349	-118	-118	-92	-83	-118	736	38	-87	-19	0	-19
60%	441	-47	-75	-23	-90	-75	812	130	-56	-3	0	0
70%	441	-47	-47	-23	-38	-42	673	148	-19	-3	0	0
80%	404	-33	-47	-29	-21	-42	401	38	-1	0	0	0
90%	413	-30	-30	13	-25	0	389	38	0	0	0	0
Long Term												
Full Simulation Period ^b	421	-112	-121	-65	-62	104	433	193	-368	-21	-15	-22
Water Year Types ^c												
Wet (23%)	407	-113	-196	-61	-27	369	14	233	-1,223	-59	-56	-76
Above Normal (24%)	404	-121	-78	-50	-83	122	230	328	-238	-1	4	-4
Below Normal (10%)	445	-148	-148	-102	-73	50	462	2	-151	-2	0	-14
Dry (16%)	412	-115	-115	-86	-80	-62	873	276	-34	-1	-6	-9
Critical (27%)	445	-87	-87	-55	-60	-23	711	58	-23	-23	-6	-3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

1 **C.36. Stanislaus River Flow at Mouth**


Figure C-36-1. Stanislaus River at Mouth, Long-Term* Average Flow

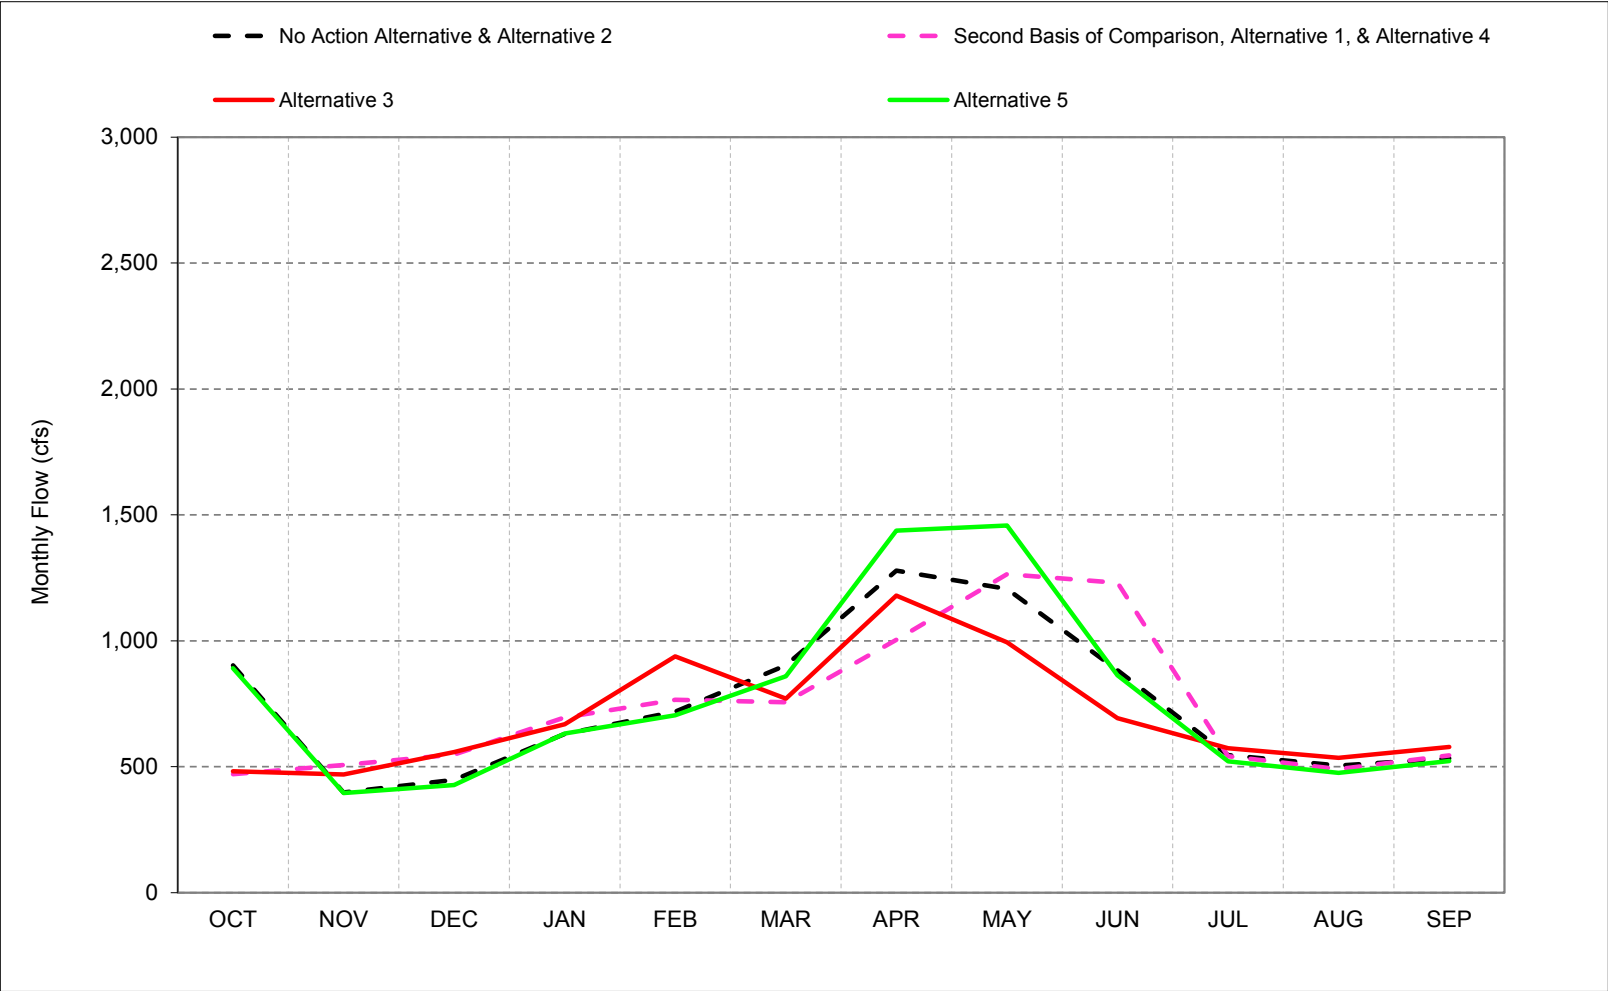

*Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-36-2. Stanislaus River at Mouth, Wet Year* Long-Term** Average Flow

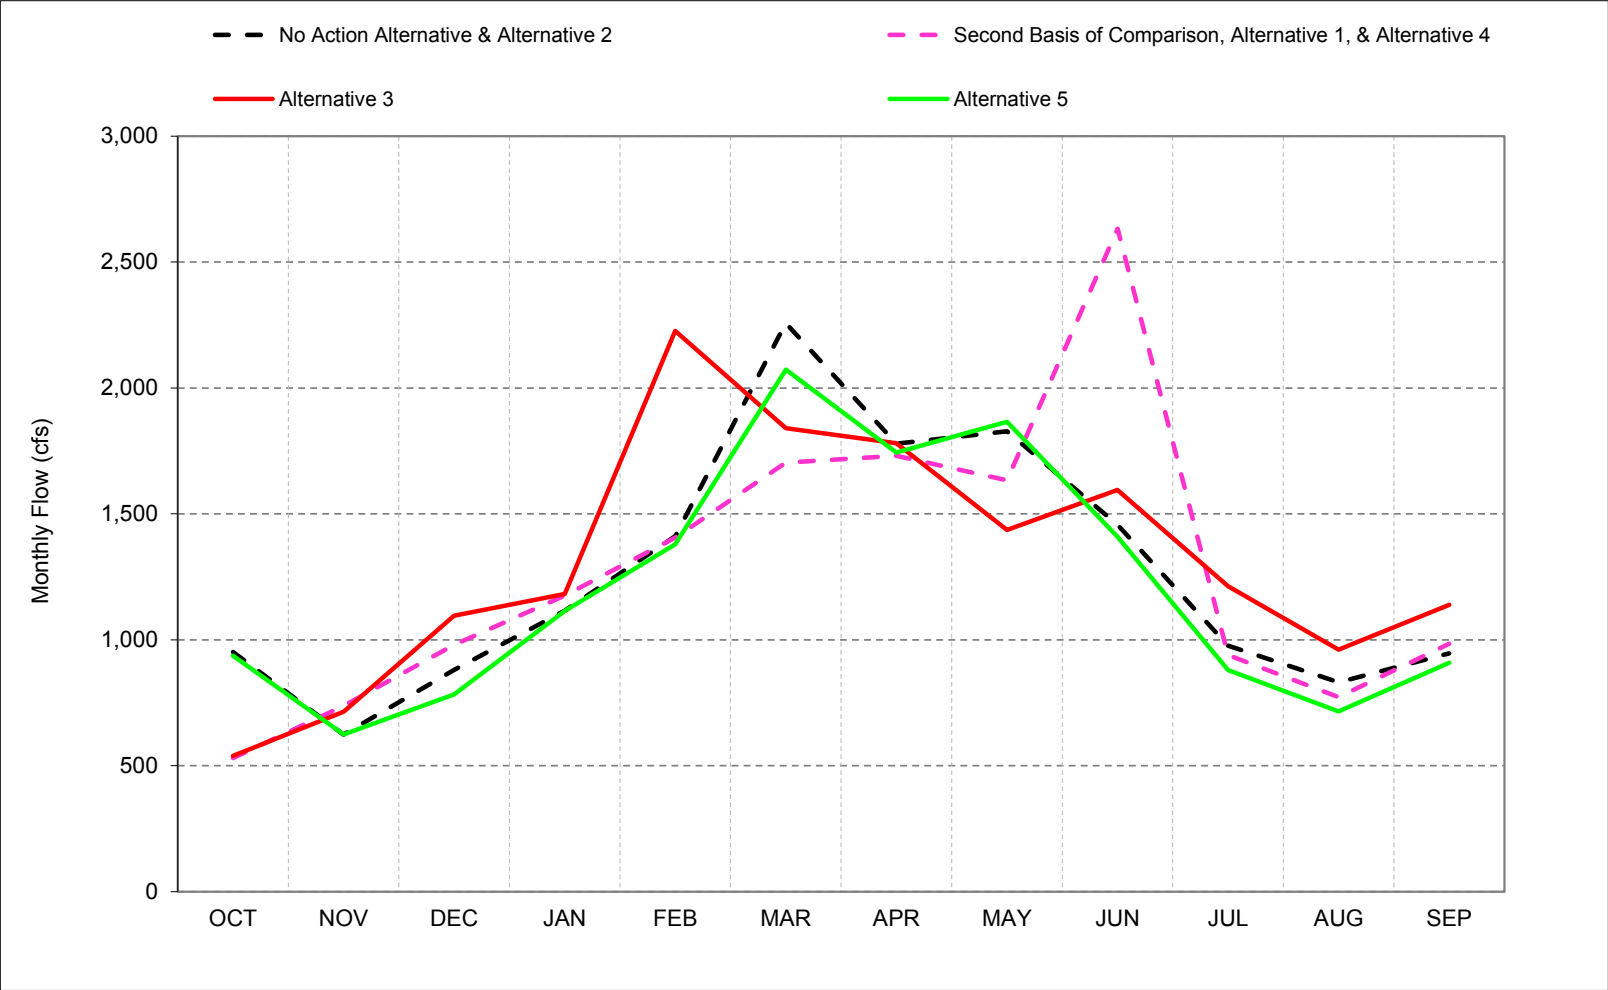


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-36-3. Stanislaus River at Mouth, Above Normal Year* Long-Term** Average Flow

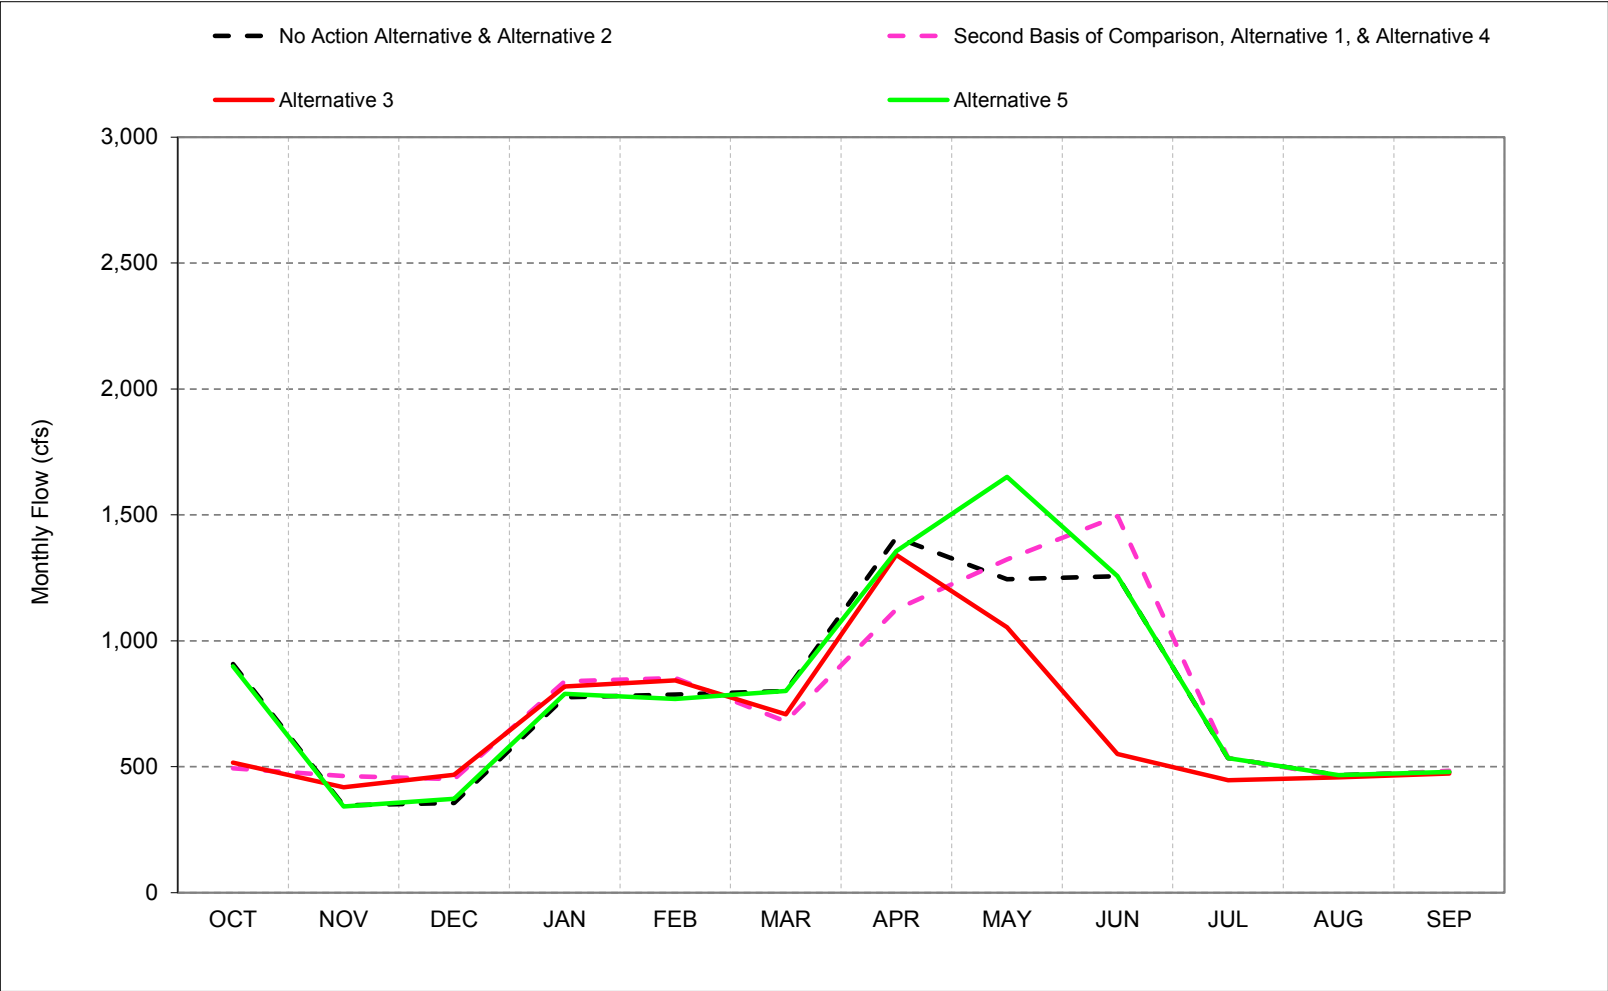


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-36-4. Stanislaus River at Mouth, Below Normal Year* Long-Term** Average Flow

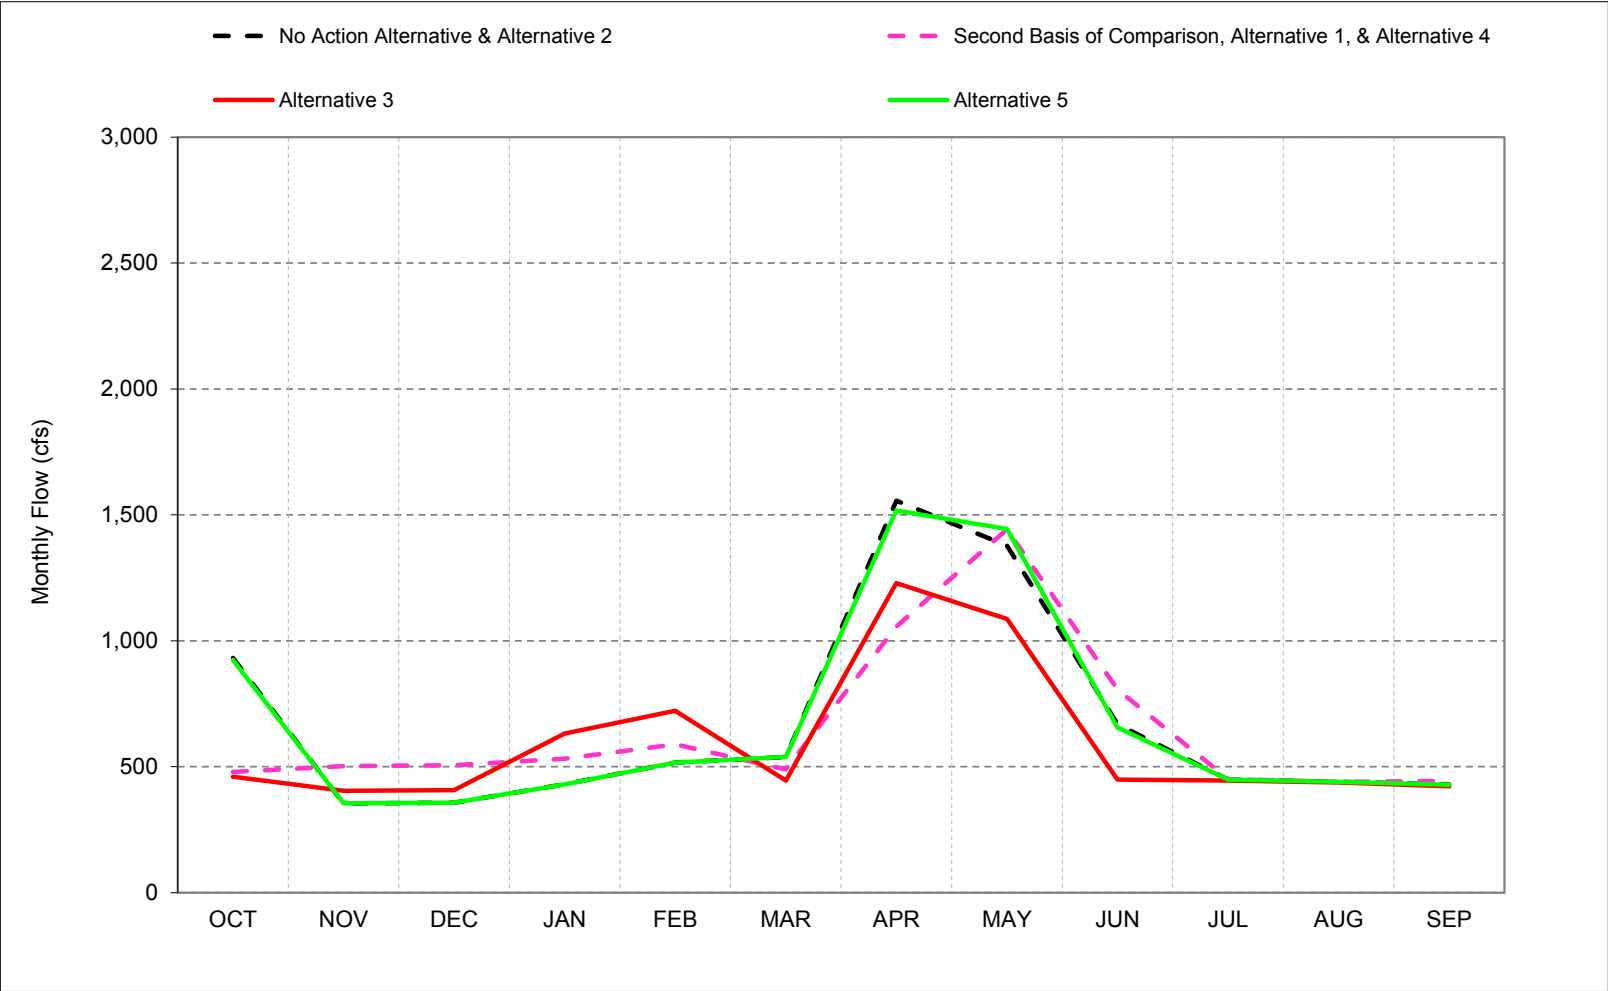


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-36-5. Stanislaus River at Mouth, Dry Year* Long-Term** Average Flow

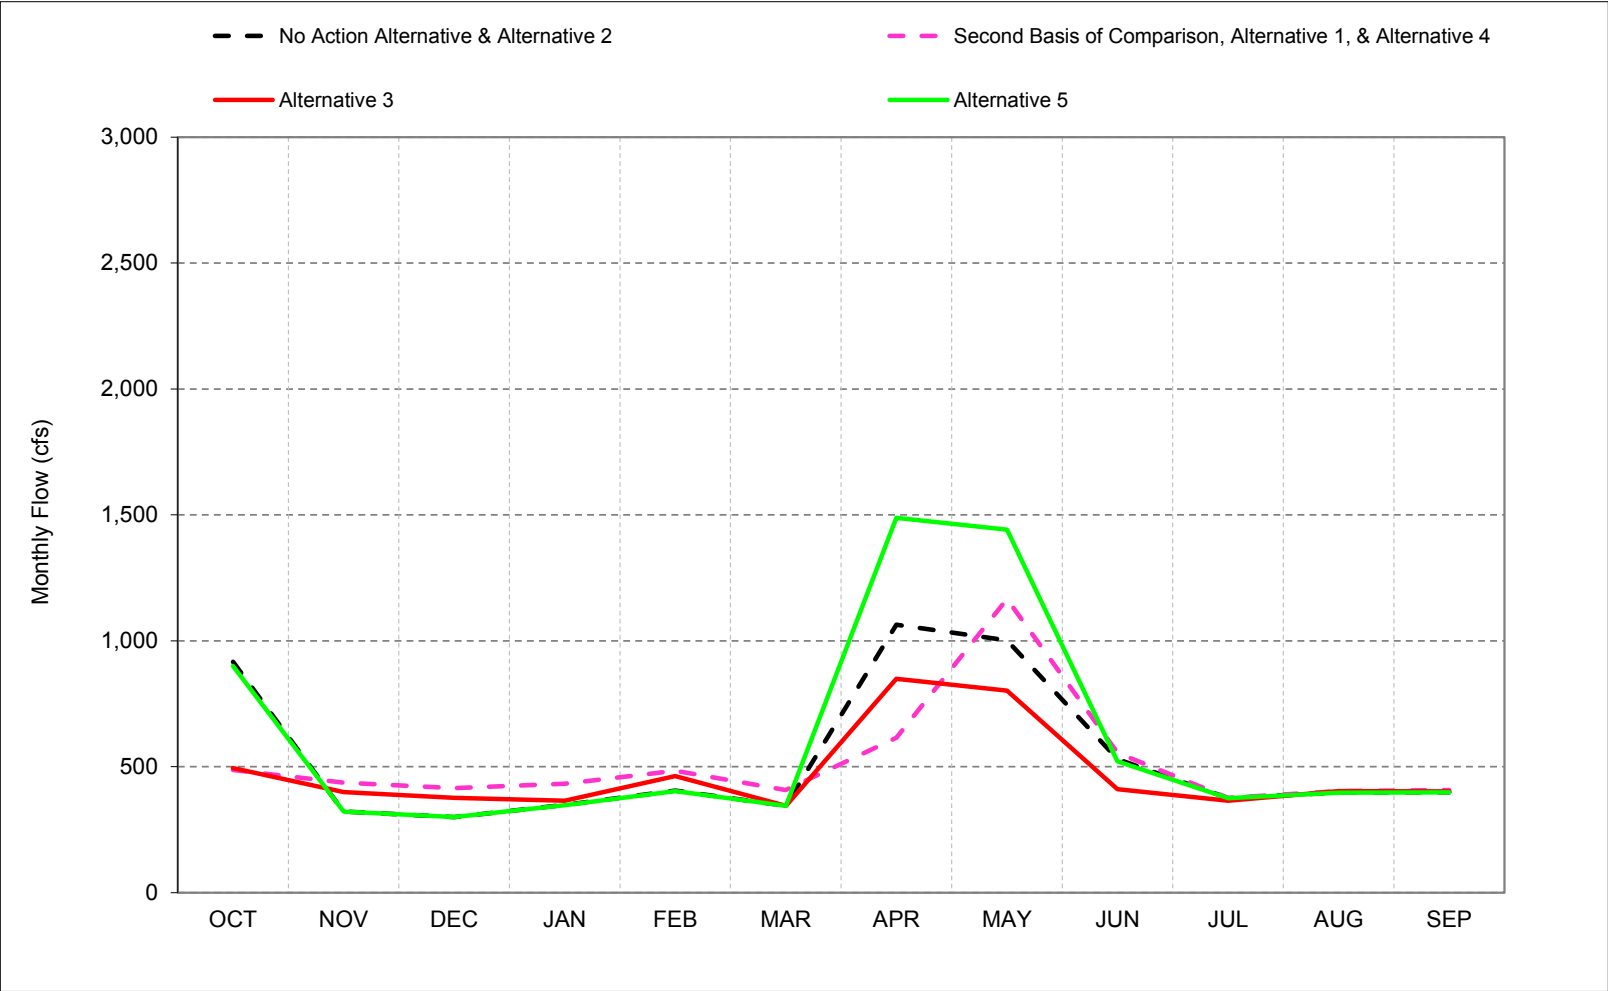


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-36-6. Stanislaus River at Mouth, Critical Year* Long-Term** Average Flow

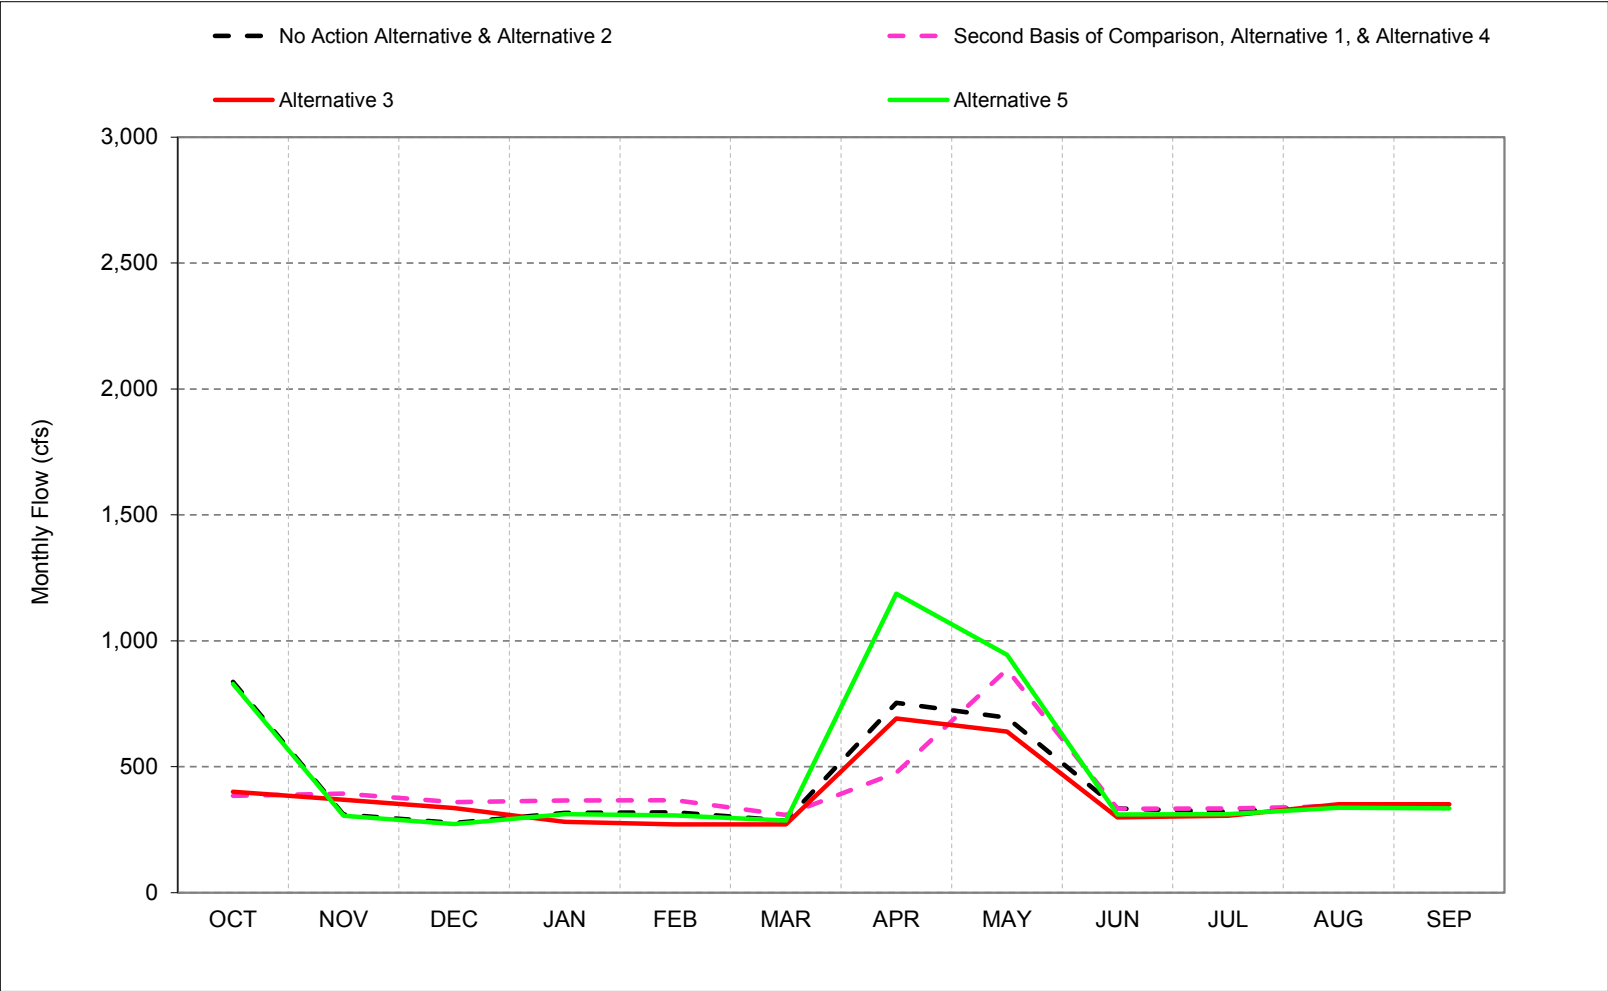

*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-36-1. Stanislaus River at Mouth, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1,122	463	442	576	1,084	1,969	1,886	1,989	1,536	751	587	646
20%	1,029	384	368	427	643	1,708	1,769	1,647	1,334	606	488	507
30%	982	348	319	368	472	520	1,696	1,536	1,221	502	462	473
40%	958	337	304	347	406	433	1,610	1,362	1,053	442	445	443
50%	879	319	290	337	369	367	1,485	1,289	635	412	445	439
60%	826	292	281	326	331	336	936	873	510	383	416	428
70%	772	267	262	312	279	314	806	755	406	372	395	389
80%	755	260	241	295	253	241	686	646	358	341	371	360
90%	676	248	224	273	230	207	572	576	311	308	331	318
Long Term												
Full Simulation Period ^b	903	398	448	630	719	903	1,279	1,207	883	546	505	533
Water Year Types ^c												
Wet (23%)	952	624	881	1,115	1,412	2,258	1,779	1,828	1,456	976	831	946
Above Normal (24%)	907	347	357	776	786	801	1,410	1,244	1,257	534	467	480
Below Normal (10%)	932	354	358	430	517	539	1,556	1,378	669	449	440	429
Dry (16%)	916	322	300	349	405	345	1,064	1,002	530	375	397	399
Critical (27%)	837	310	277	317	319	286	754	695	335	321	346	342

Alternative 1												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	662	653	656	688	1,117	1,153	1,804	1,679	3,009	661	569	673
20%	582	548	522	557	694	613	1,608	1,592	2,016	555	485	508
30%	507	492	464	518	562	562	1,489	1,533	1,772	502	461	481
40%	471	459	427	473	512	522	1,040	1,423	1,092	444	445	457
50%	405	421	378	412	484	446	821	1,331	694	412	443	439
60%	377	388	341	364	423	394	637	1,049	572	386	416	431
70%	346	355	329	339	331	361	529	972	402	378	395	396
80%	327	312	311	318	296	295	440	865	352	350	373	373
90%	249	280	269	283	257	233	406	787	312	318	331	316
Long Term												
Full Simulation Period ^b	471	507	549	696	766	756	1,004	1,265	1,231	542	491	545
Water Year Types ^c												
Wet (23%)	530	737	980	1,176	1,407	1,704	1,731	1,634	2,632	939	772	985
Above Normal (24%)	494	463	451	840	852	680	1,126	1,323	1,495	535	463	484
Below Normal (10%)	480	503	506	532	589	489	1,057	1,443	807	452	440	443
Dry (16%)	487	437	415	433	484	407	616	1,166	555	377	404	408
Critical (27%)	384	393	360	366	367	309	476	887	334	335	343	338

Alternative 1 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-461	190	214	112	33	-816	-82	-311	1,473	-90	-18	28
20%	-447	165	154	130	51	-1,094	-161	-55	682	-51	-3	1
30%	-475	145	146	150	89	42	-208	-3	551	0	-1	9
40%	-488	122	123	125	106	89	-570	61	39	2	0	13
50%	-474	102	88	74	115	80	-663	42	59	0	-2	0
60%	-449	96	61	38	92	59	-299	176	62	2	0	3
70%	-426	88	67	27	52	48	-277	218	-4	5	0	8
80%	-427	52	70	23	43	54	-247	219	-5	9	2	12
90%	-427	32	46	9	27	26	-165	211	1	9	0	-2
Long Term												
Full Simulation Period ^b	-432	110	101	66	47	-147	-275	58	348	-4	-15	12
Water Year Types ^c												
Wet (23%)	-421	113	99	61	-5	-554	-48	-195	1,176	-37	-59	39
Above Normal (24%)	-413	116	94	63	66	-122	-284	79	238	1	-4	4
Below Normal (10%)	-453	148	148	101	72	-50	-500	65	138	2	0	14
Dry (16%)	-429	115	115	84	79	62	-449	164	25	1	6	9
Critical (27%)	-453	83	83	49	47	23	-277	192	-1	14	-3	-3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-36-2. Stanislaus River at Mouth, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1,122	463	442	576	1,084	1,969	1,886	1,989	1,536	751	587	646
20%	1,029	384	368	427	643	1,708	1,769	1,647	1,334	606	488	507
30%	982	348	319	368	472	520	1,696	1,536	1,221	502	462	473
40%	958	337	304	347	406	433	1,610	1,362	1,053	442	445	443
50%	879	319	290	337	369	367	1,485	1,289	635	412	445	439
60%	826	292	281	326	331	336	936	873	510	383	416	428
70%	772	267	262	312	279	314	806	755	406	372	395	389
80%	755	260	241	295	253	241	686	646	358	341	371	360
90%	676	248	224	273	230	207	572	576	311	308	331	318
Long Term												
Full Simulation Period ^b	903	398	448	630	719	903	1,279	1,207	883	546	505	533
Water Year Types ^c												
Wet (23%)	952	624	881	1,115	1,412	2,258	1,779	1,828	1,456	976	831	946
Above Normal (24%)	907	347	357	776	786	801	1,410	1,244	1,257	534	467	480
Below Normal (10%)	932	354	358	430	517	539	1,556	1,378	669	449	440	429
Dry (16%)	916	322	300	349	405	345	1,064	1,002	530	375	397	399
Critical (27%)	837	310	277	317	319	286	754	695	335	321	346	342

Alternative 3												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	679	485	722	1,267	2,628	1,444	1,865	1,414	950	885	571	1,146
20%	557	456	438	518	1,301	734	1,634	1,306	679	535	480	489
30%	482	441	411	410	502	486	1,552	1,233	558	476	457	450
40%	448	424	400	374	416	419	1,240	1,043	428	424	445	439
50%	435	402	381	311	366	367	1,064	920	413	382	440	435
60%	392	372	362	275	308	334	996	882	374	374	410	415
70%	377	359	325	251	238	312	893	829	352	350	390	384
80%	360	333	300	232	201	238	575	550	304	327	367	360
90%	293	260	239	198	180	203	493	489	273	290	347	320
Long Term												
Full Simulation Period ^b	482	469	558	669	938	770	1,180	995	693	573	535	578
Water Year Types ^c												
Wet (23%)	539	714	1,096	1,183	2,227	1,841	1,781	1,437	1,596	1,213	961	1,139
Above Normal (24%)	516	418	468	818	843	708	1,341	1,054	550	446	457	473
Below Normal (10%)	461	404	408	632	723	446	1,230	1,086	449	445	438	422
Dry (16%)	495	399	377	365	463	345	849	803	411	365	404	402
Critical (27%)	401	369	336	282	272	271	692	639	299	305	351	351

Alternative 3 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-443	22	279	690	1,545	-525	-22	-575	-586	133	-16	500
20%	-472	72	71	92	658	-974	-135	-341	-654	-71	-8	-18
30%	-501	93	92	42	30	-34	-144	-303	-663	-25	-5	-23
40%	-511	87	95	26	11	-14	-370	-319	-626	-18	0	-4
50%	-444	83	91	-26	-3	0	-420	-368	-222	-29	-4	-5
60%	-434	80	81	-50	-23	-2	59	9	-136	-9	-5	-12
70%	-395	93	63	-61	-41	-2	87	74	-54	-22	-5	-5
80%	-395	73	59	-63	-52	-3	-112	-96	-54	-13	-3	0
90%	-383	12	16	-75	-50	-4	-78	-88	-39	-18	16	2
Long Term												
Full Simulation Period ^b	-421	71	110	39	219	-132	-99	-212	-190	27	30	45
Water Year Types ^c												
Wet (23%)	-413	90	215	67	815	-417	2	-392	139	237	130	193
Above Normal (24%)	-391	71	112	42	57	-93	-69	-191	-707	-88	-9	-7
Below Normal (10%)	-471	50	50	201	206	-93	-327	-292	-220	-4	-2	-7
Dry (16%)	-422	77	77	16	58	0	-215	-199	-119	-10	6	3
Critical (27%)	-436	59	59	-36	-47	-15	-61	-56	-35	-15	6	9

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-36-3. Stanislaus River at Mouth, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1,122	463	442	576	1,084	1,969	1,886	1,989	1,536	751	587	646
20%	1,029	384	368	427	643	1,708	1,769	1,647	1,334	606	488	507
30%	982	348	319	368	472	520	1,696	1,536	1,221	502	462	473
40%	958	337	304	347	406	433	1,610	1,362	1,053	442	445	443
50%	879	319	290	337	369	367	1,485	1,289	635	412	445	439
60%	826	292	281	326	331	336	936	873	510	383	416	428
70%	772	267	262	312	279	314	806	755	406	372	395	389
80%	755	260	241	295	253	241	686	646	358	341	371	360
90%	676	248	224	273	230	207	572	576	311	308	331	318
Long Term												
Full Simulation Period ^b	903	398	448	630	719	903	1,279	1,207	883	546	505	533
Water Year Types ^c												
Wet (23%)	952	624	881	1,115	1,412	2,258	1,779	1,828	1,456	976	831	946
Above Normal (24%)	907	347	357	776	786	801	1,410	1,244	1,257	534	467	480
Below Normal (10%)	932	354	358	430	517	539	1,556	1,378	669	449	440	429
Dry (16%)	916	322	300	349	405	345	1,064	1,002	530	375	397	399
Critical (27%)	837	310	277	317	319	286	754	695	335	321	346	342

Alternative 5												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1,121	456	442	570	1,081	1,952	1,950	2,148	1,536	719	571	659
20%	1,029	382	378	416	586	1,708	1,815	1,974	1,319	564	488	501
30%	979	348	319	363	483	495	1,707	1,806	1,139	502	461	473
40%	903	336	304	347	401	415	1,630	1,672	1,034	442	445	443
50%	854	318	290	337	368	365	1,529	1,434	635	407	443	439
60%	818	292	281	326	319	333	1,311	1,290	485	382	413	428
70%	764	267	262	312	272	312	1,168	1,183	383	371	389	389
80%	748	260	241	295	245	241	1,044	962	343	339	367	356
90%	681	248	224	270	230	207	865	752	300	307	305	316
Long Term												
Full Simulation Period ^b	891	396	428	631	704	860	1,437	1,458	863	521	476	522
Water Year Types ^c												
Wet (23%)	937	624	784	1,115	1,380	2,073	1,744	1,866	1,409	880	716	909
Above Normal (24%)	898	342	372	790	770	801	1,356	1,651	1,257	534	467	480
Below Normal (10%)	925	354	358	430	516	539	1,518	1,444	656	449	440	429
Dry (16%)	900	322	300	347	403	345	1,488	1,442	522	375	397	399
Critical (27%)	829	306	272	311	306	286	1,187	944	310	311	337	335

Alternative 5 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-2	-7	0	-6	-3	-17	64	158	0	-32	-16	13
20%	0	-2	10	-11	-57	0	46	327	-15	-42	0	-6
30%	-4	0	0	-6	10	-25	10	270	-82	0	-1	0
40%	-56	-1	0	-1	-4	-18	21	310	-19	0	0	0
50%	-25	-1	0	0	-1	-2	44	145	0	-4	-2	0
60%	-8	0	0	0	-12	-3	375	417	-25	-1	-3	0
70%	-7	0	0	0	-8	-2	362	428	-23	-2	-6	0
80%	-6	0	0	0	-8	0	357	316	-15	-2	-3	-4
90%	5	0	0	-3	0	0	293	176	-12	-1	-25	-2
Long Term												
Full Simulation Period ^b	-11	-2	-20	1	-15	-43	159	251	-20	-25	-29	-11
Water Year Types ^c												
Wet (23%)	-15	0	-97	0	-33	-185	-34	38	-47	-96	-115	-38
Above Normal (24%)	-9	-5	16	13	-17	0	-55	407	0	0	0	0
Below Normal (10%)	-7	0	0	-1	-1	0	-38	66	-13	0	0	0
Dry (16%)	-17	0	0	-1	-2	0	424	440	-8	0	0	0
Critical (27%)	-8	-5	-5	-6	-13	0	434	250	-24	-10	-9	-7

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-36-4. Stanislaus River at Mouth, Monthly Flow

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	662	653	656	688	1,117	1,153	1,804	1,679	3,009	661	569	673
20%	582	548	522	557	694	613	1,608	1,592	2,016	555	485	508
30%	507	492	464	518	562	562	1,489	1,533	1,772	502	461	481
40%	471	459	427	473	512	522	1,040	1,423	1,092	444	445	457
50%	405	421	378	412	484	446	821	1,331	694	412	443	439
60%	377	388	341	364	423	394	637	1,049	572	386	416	431
70%	346	355	329	339	331	361	529	972	402	378	395	396
80%	327	312	311	318	296	295	440	865	352	350	373	373
90%	249	280	269	283	257	233	406	787	312	318	331	316
Long Term												
Full Simulation Period ^b	471	507	549	696	766	756	1,004	1,265	1,231	542	491	545
Water Year Types ^c												
Wet (23%)	530	737	980	1,176	1,407	1,704	1,731	1,634	2,632	939	772	985
Above Normal (24%)	494	463	451	840	852	680	1,126	1,323	1,495	535	463	484
Below Normal (10%)	480	503	506	532	589	489	1,057	1,443	807	452	440	443
Dry (16%)	487	437	415	433	484	407	616	1,166	555	377	404	408
Critical (27%)	384	393	360	366	367	309	476	887	334	335	343	338

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance ^a												
10%	1,122	463	442	576	1,084	1,969	1,886	1,989	1,536	751	587	646
20%	1,029	384	368	427	643	1,708	1,769	1,647	1,334	606	488	507
30%	982	348	319	368	472	520	1,696	1,536	1,221	502	462	473
40%	958	337	304	347	406	433	1,610	1,362	1,053	442	445	443
50%	879	319	290	337	369	367	1,485	1,289	635	412	445	439
60%	826	292	281	326	331	336	936	873	510	383	416	428
70%	772	267	262	312	279	314	806	755	406	372	395	389
80%	755	260	241	295	253	241	686	646	358	341	371	360
90%	676	248	224	273	230	207	572	576	311	308	331	318
Long Term												
Full Simulation Period ^b	903	398	448	630	719	903	1,279	1,207	883	546	505	533
Water Year Types ^c												
Wet (23%)	952	624	881	1,115	1,412	2,258	1,779	1,828	1,456	976	831	946
Above Normal (24%)	907	347	357	776	786	801	1,410	1,244	1,257	534	467	480
Below Normal (10%)	932	354	358	430	517	539	1,556	1,378	669	449	440	429
Dry (16%)	916	322	300	349	405	345	1,064	1,002	530	375	397	399
Critical (27%)	837	310	277	317	319	286	754	695	335	321	346	342

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative minus Second Basis of Comparison												
Probability of Exceedance ^a												
10%	461	-190	-214	-112	-33	816	82	311	-1,473	90	18	-28
20%	447	-165	-154	-130	-51	1,094	161	55	-682	51	3	-1
30%	475	-145	-146	-150	-89	-42	208	3	-551	0	1	-9
40%	488	-122	-123	-125	-106	-89	570	-61	-39	-2	0	-13
50%	474	-102	-88	-74	-115	-80	663	-42	-59	0	2	0
60%	449	-96	-61	-38	-92	-59	299	-176	-62	-2	0	-3
70%	426	-88	-67	-27	-52	-48	277	-218	4	-5	0	-8
80%	427	-52	-70	-23	-43	-54	247	-219	5	-9	-2	-12
90%	427	-32	-46	-9	-27	-26	165	-211	-1	-9	0	2
Long Term												
Full Simulation Period ^b	432	-110	-101	-66	-47	147	275	-58	-348	4	15	-12
Water Year Types ^c												
Wet (23%)	421	-113	-99	-61	5	554	48	195	-1,176	37	59	-39
Above Normal (24%)	413	-116	-94	-63	-66	122	284	-79	-238	-1	4	-4
Below Normal (10%)	453	-148	-148	-101	-72	50	500	-65	-138	-2	0	-14
Dry (16%)	429	-115	-115	-84	-79	-62	449	-164	-25	-1	-6	-9
Critical (27%)	453	-83	-83	-49	-47	-23	277	-192	1	-14	3	3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-36-5. Stanislaus River at Mouth, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	662	653	656	688	1,117	1,153	1,804	1,679	3,009	661	569	673
20%	582	548	522	557	694	613	1,608	1,592	2,016	555	485	508
30%	507	492	464	518	562	562	1,489	1,533	1,772	502	461	481
40%	471	459	427	473	512	522	1,040	1,423	1,092	444	445	457
50%	405	421	378	412	484	446	821	1,331	694	412	443	439
60%	377	388	341	364	423	394	637	1,049	572	386	416	431
70%	346	355	329	339	331	361	529	972	402	378	395	396
80%	327	312	311	318	296	295	440	865	352	350	373	373
90%	249	280	269	283	257	233	406	787	312	318	331	316
Long Term												
Full Simulation Period ^b	471	507	549	696	766	756	1,004	1,265	1,231	542	491	545
Water Year Types ^c												
Wet (23%)	530	737	980	1,176	1,407	1,704	1,731	1,634	2,632	939	772	985
Above Normal (24%)	494	463	451	840	852	680	1,126	1,323	1,495	535	463	484
Below Normal (10%)	480	503	506	532	589	489	1,057	1,443	807	452	440	443
Dry (16%)	487	437	415	433	484	407	616	1,166	555	377	404	408
Critical (27%)	384	393	360	366	367	309	476	887	334	335	343	338

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	679	485	722	1,267	2,628	1,444	1,865	1,414	950	885	571	1,146
20%	557	456	438	518	1,301	734	1,634	1,306	679	535	480	489
30%	482	441	411	410	502	486	1,552	1,233	558	476	457	450
40%	448	424	400	374	416	419	1,240	1,043	428	424	445	439
50%	435	402	381	311	366	367	1,064	920	413	382	440	435
60%	392	372	362	275	308	334	996	882	374	374	410	415
70%	377	359	325	251	238	312	893	829	352	350	390	384
80%	360	333	300	232	201	238	575	550	304	327	367	360
90%	293	260	239	198	180	203	493	489	273	290	347	320
Long Term												
Full Simulation Period ^b	482	469	558	669	938	770	1,180	995	693	573	535	578
Water Year Types ^c												
Wet (23%)	539	714	1,096	1,183	2,227	1,841	1,781	1,437	1,596	1,213	961	1,139
Above Normal (24%)	516	418	468	818	843	708	1,341	1,054	550	446	457	473
Below Normal (10%)	461	404	408	632	723	446	1,230	1,086	449	445	438	422
Dry (16%)	495	399	377	365	463	345	849	803	411	365	404	402
Critical (27%)	401	369	336	282	272	271	692	639	299	305	351	351

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	17	-168	65	578	1,512	291	60	-265	-2,059	223	2	473
20%	-26	-93	-84	-39	607	121	26	-286	-1,336	-20	-5	-19
30%	-26	-51	-53	-108	-59	-76	63	-300	-1,214	-25	-4	-32
40%	-23	-36	-28	-99	-96	-103	200	-380	-664	-20	0	-17
50%	30	-19	2	-100	-119	-80	243	-410	-281	-29	-2	-5
60%	15	-16	20	-89	-115	-61	359	-167	-199	-12	-5	-15
70%	31	4	-4	-88	-93	-49	364	-143	-50	-28	-5	-13
80%	33	21	-11	-86	-95	-56	135	-315	-49	-23	-5	-12
90%	44	-20	-30	-84	-77	-30	87	-299	-39	-27	16	4
Long Term												
Full Simulation Period ^b	11	-38	9	-27	172	15	176	-270	-538	32	45	33
Water Year Types ^c												
Wet (23%)	8	-23	116	6	820	137	50	-197	-1,037	274	189	154
Above Normal (24%)	22	-45	18	-21	-9	29	215	-269	-945	-89	-5	-11
Below Normal (10%)	-19	-98	-98	100	134	-43	173	-356	-358	-7	-2	-21
Dry (16%)	7	-38	-38	-68	-21	-62	234	-364	-144	-11	0	-6
Critical (27%)	17	-24	-24	-84	-95	-38	216	-247	-35	-29	9	12

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-36-6. Stanislaus River at Mouth, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	662	653	656	688	1,117	1,153	1,804	1,679	3,009	661	569	673
20%	582	548	522	557	694	613	1,608	1,592	2,016	555	485	508
30%	507	492	464	518	562	562	1,489	1,533	1,772	502	461	481
40%	471	459	427	473	512	522	1,040	1,423	1,092	444	445	457
50%	405	421	378	412	484	446	821	1,331	694	412	443	439
60%	377	388	341	364	423	394	637	1,049	572	386	416	431
70%	346	355	329	339	331	361	529	972	402	378	395	396
80%	327	312	311	318	296	295	440	865	352	350	373	373
90%	249	280	269	283	257	233	406	787	312	318	331	316
Long Term												
Full Simulation Period ^b	471	507	549	696	766	756	1,004	1,265	1,231	542	491	545
Water Year Types ^c												
Wet (23%)	530	737	980	1,176	1,407	1,704	1,731	1,634	2,632	939	772	985
Above Normal (24%)	494	463	451	840	852	680	1,126	1,323	1,495	535	463	484
Below Normal (10%)	480	503	506	532	589	489	1,057	1,443	807	452	440	443
Dry (16%)	487	437	415	433	484	407	616	1,166	555	377	404	408
Critical (27%)	384	393	360	366	367	309	476	887	334	335	343	338

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1,121	456	442	570	1,081	1,952	1,950	2,148	1,536	719	571	659
20%	1,029	382	378	416	586	1,708	1,815	1,974	1,319	564	488	501
30%	979	348	319	363	483	495	1,707	1,806	1,139	502	461	473
40%	903	336	304	347	401	415	1,630	1,672	1,034	442	445	443
50%	854	318	290	337	368	365	1,529	1,434	635	407	443	439
60%	818	292	281	326	319	333	1,311	1,290	485	382	413	428
70%	764	267	262	312	272	312	1,168	1,183	383	371	389	389
80%	748	260	241	295	245	241	1,044	962	343	339	367	356
90%	681	248	224	270	230	207	865	752	300	307	305	316
Long Term												
Full Simulation Period ^b	891	396	428	631	704	860	1,437	1,458	863	521	476	522
Water Year Types ^c												
Wet (23%)	937	624	784	1,115	1,380	2,073	1,744	1,866	1,409	880	716	909
Above Normal (24%)	898	342	372	790	770	801	1,356	1,651	1,257	534	467	480
Below Normal (10%)	925	354	358	430	516	539	1,518	1,444	656	449	440	429
Dry (16%)	900	322	300	347	403	345	1,488	1,442	522	375	397	399
Critical (27%)	829	306	272	311	306	286	1,187	944	310	311	337	335

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	459	-197	-214	-118	-36	799	146	469	-1,473	58	2	-15
20%	447	-166	-144	-141	-109	1,094	207	381	-697	9	3	-7
30%	471	-145	-146	-155	-79	218	273	218	-633	0	0	-9
40%	432	-123	-123	-126	-110	-107	590	248	-58	-2	0	-13
50%	449	-103	-88	-74	-116	-82	708	103	-59	-4	0	0
60%	441	-96	-61	-38	-104	-61	674	241	-87	-4	-3	-3
70%	418	-88	-67	-27	-60	-49	639	211	-19	-7	-6	-8
80%	421	-52	-70	-23	-50	-54	604	97	-9	-11	-5	-16
90%	432	-32	-46	-13	-27	-26	459	-35	-13	-11	-25	0
Long Term												
Full Simulation Period ^b	421	-112	-121	-65	-62	104	433	193	-368	-21	-15	-22
Water Year Types ^c												
Wet (23%)	407	-113	-196	-61	-27	369	14	233	-1,223	-59	-56	-76
Above Normal (24%)	404	-121	-78	-50	-83	122	230	328	-238	-1	4	-4
Below Normal (10%)	445	-148	-148	-102	-73	50	462	2	-151	-2	0	-14
Dry (16%)	412	-115	-115	-86	-80	-62	873	276	-34	-1	-6	-9
Critical (27%)	445	-87	-87	-55	-60	-23	711	58	-23	-23	-6	-3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

1 **C.37. San Joaquin River Flow downstream of Merced River**
2 **Confluence**


Figure C-37-1. San Joaquin River d/s of Merced Confluence, Long-Term* Average Flow

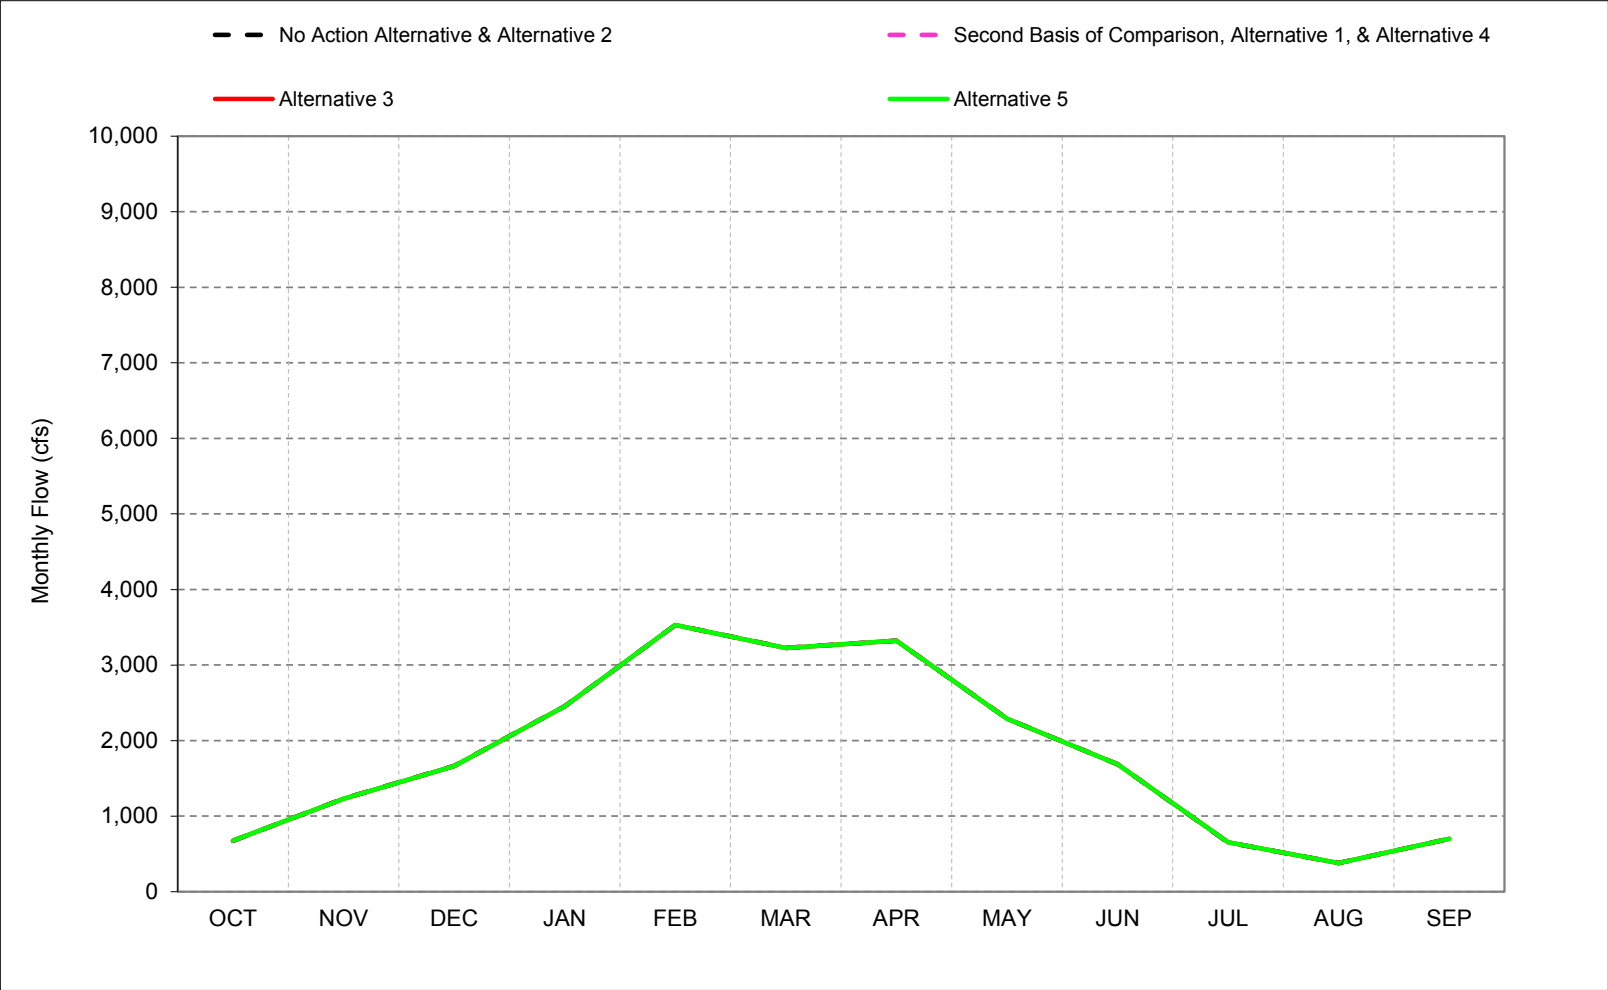

*Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-37-2. San Joaquin River d/s of Merced Confluence, Wet Year* Long-Term** Average Flow

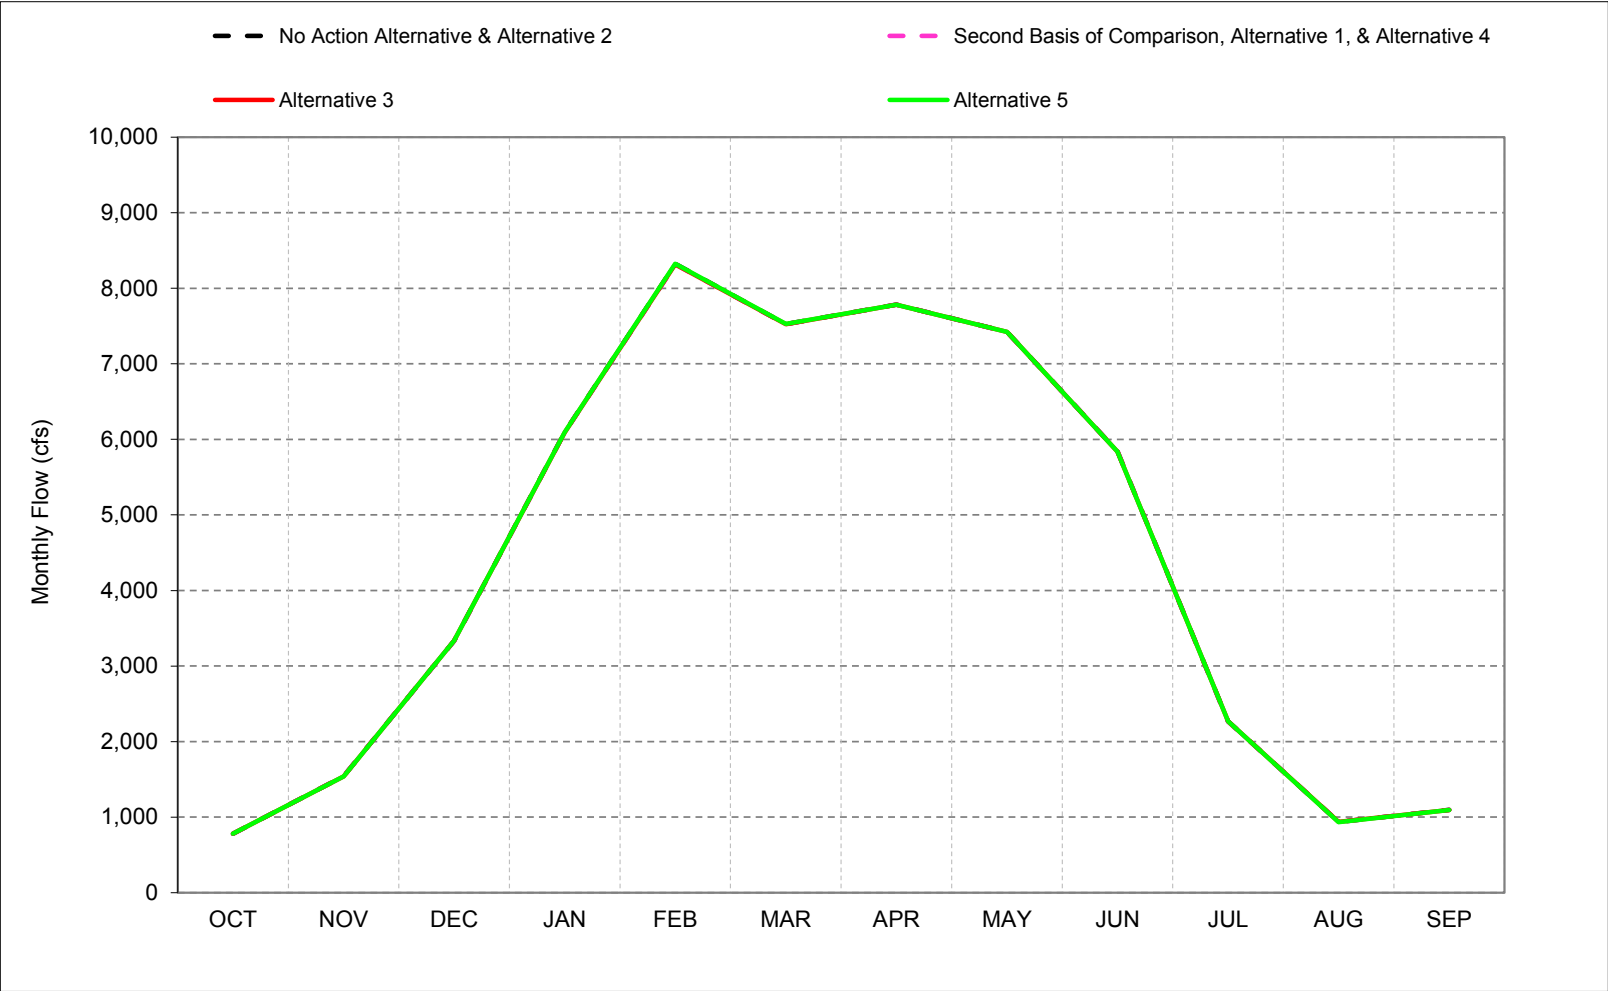


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-37-3. San Joaquin River d/s of Merced Confluence, Above Normal Year* Long-Term** Average Flow

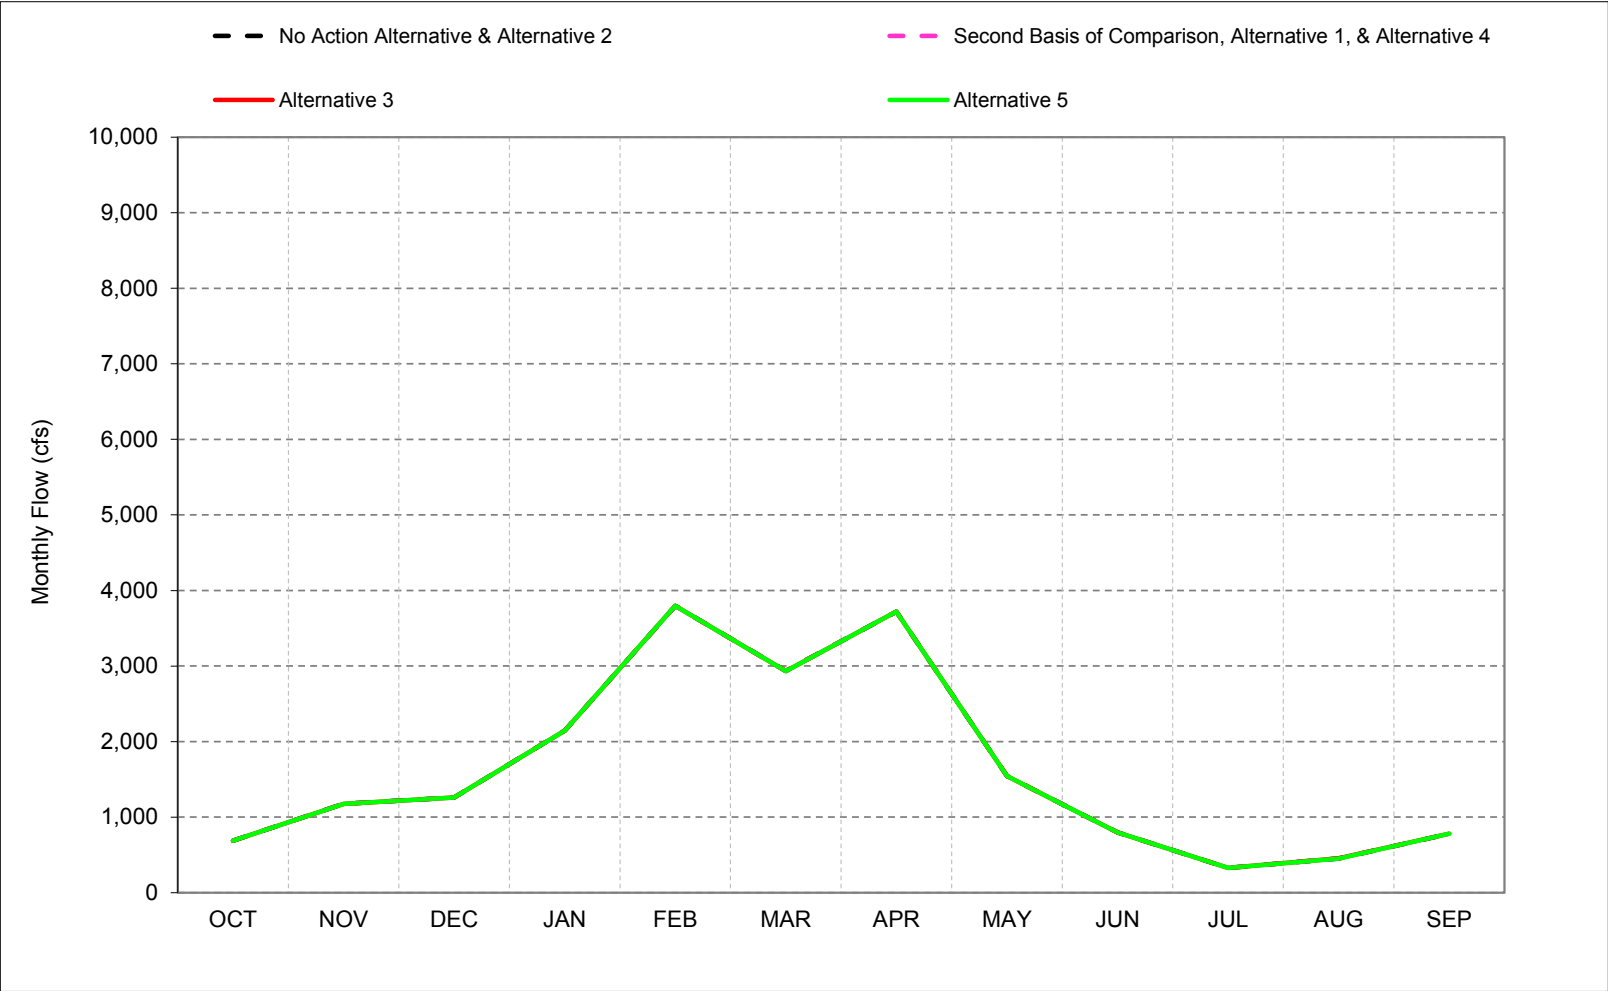


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-37-4. San Joaquin River d/s of Merced Confluence, Below Normal Year* Long-Term** Average Flow

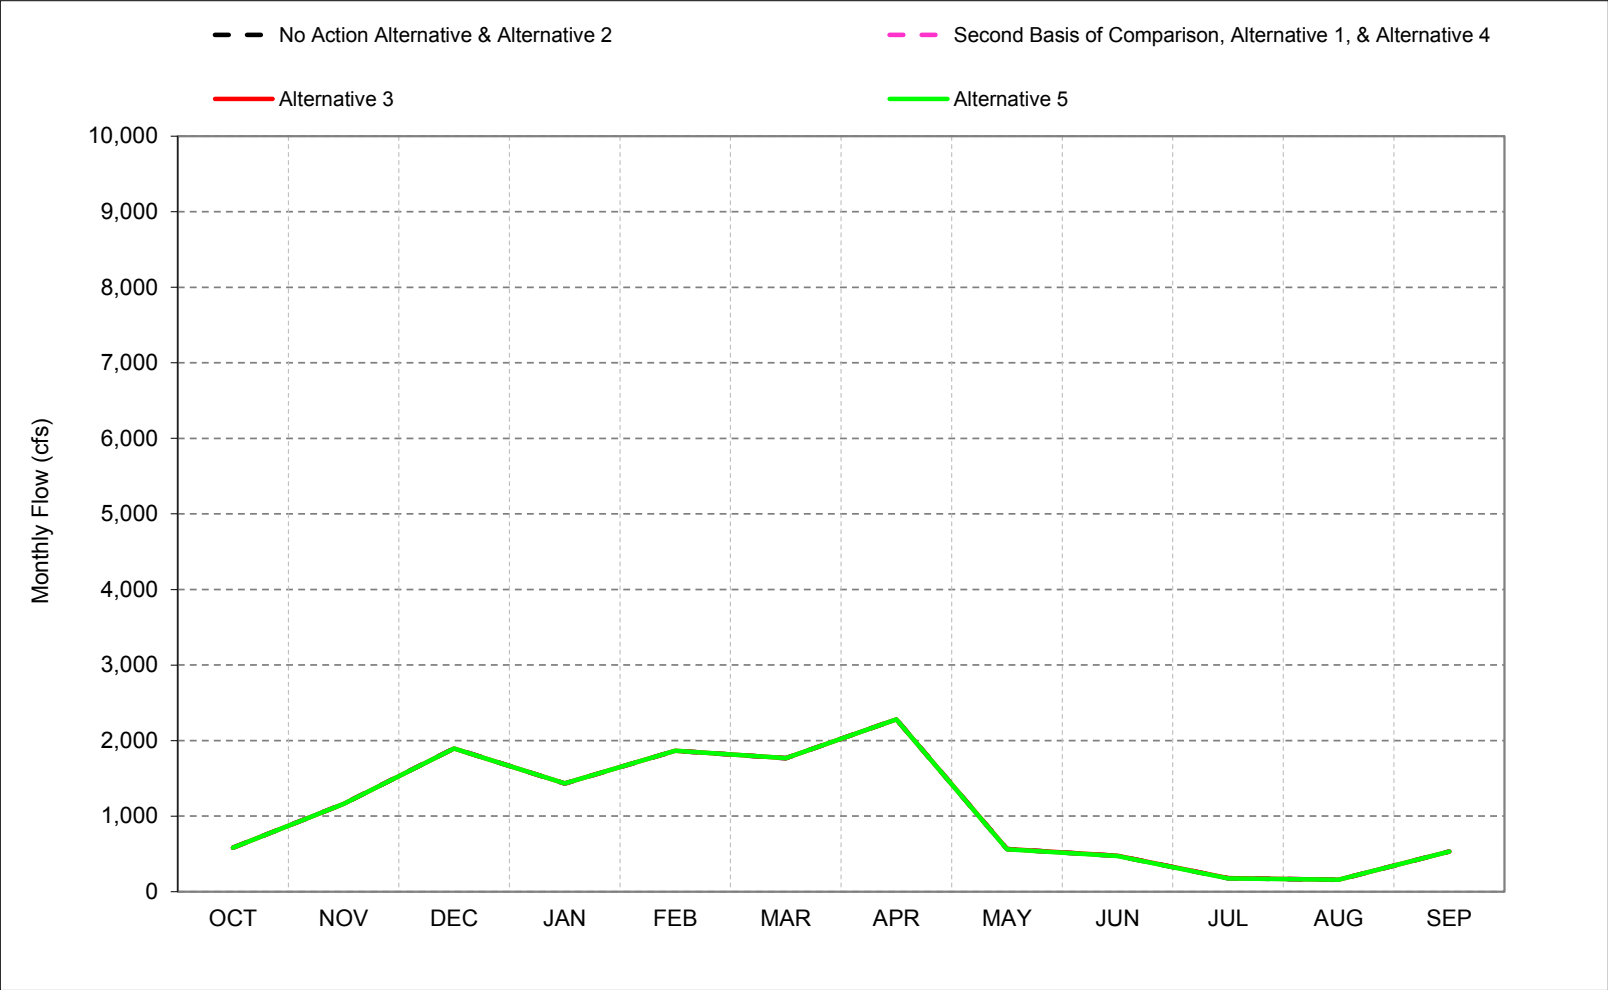


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-37-5. San Joaquin River d/s of Merced Confluence, Dry Year* Long-Term** Average Flow

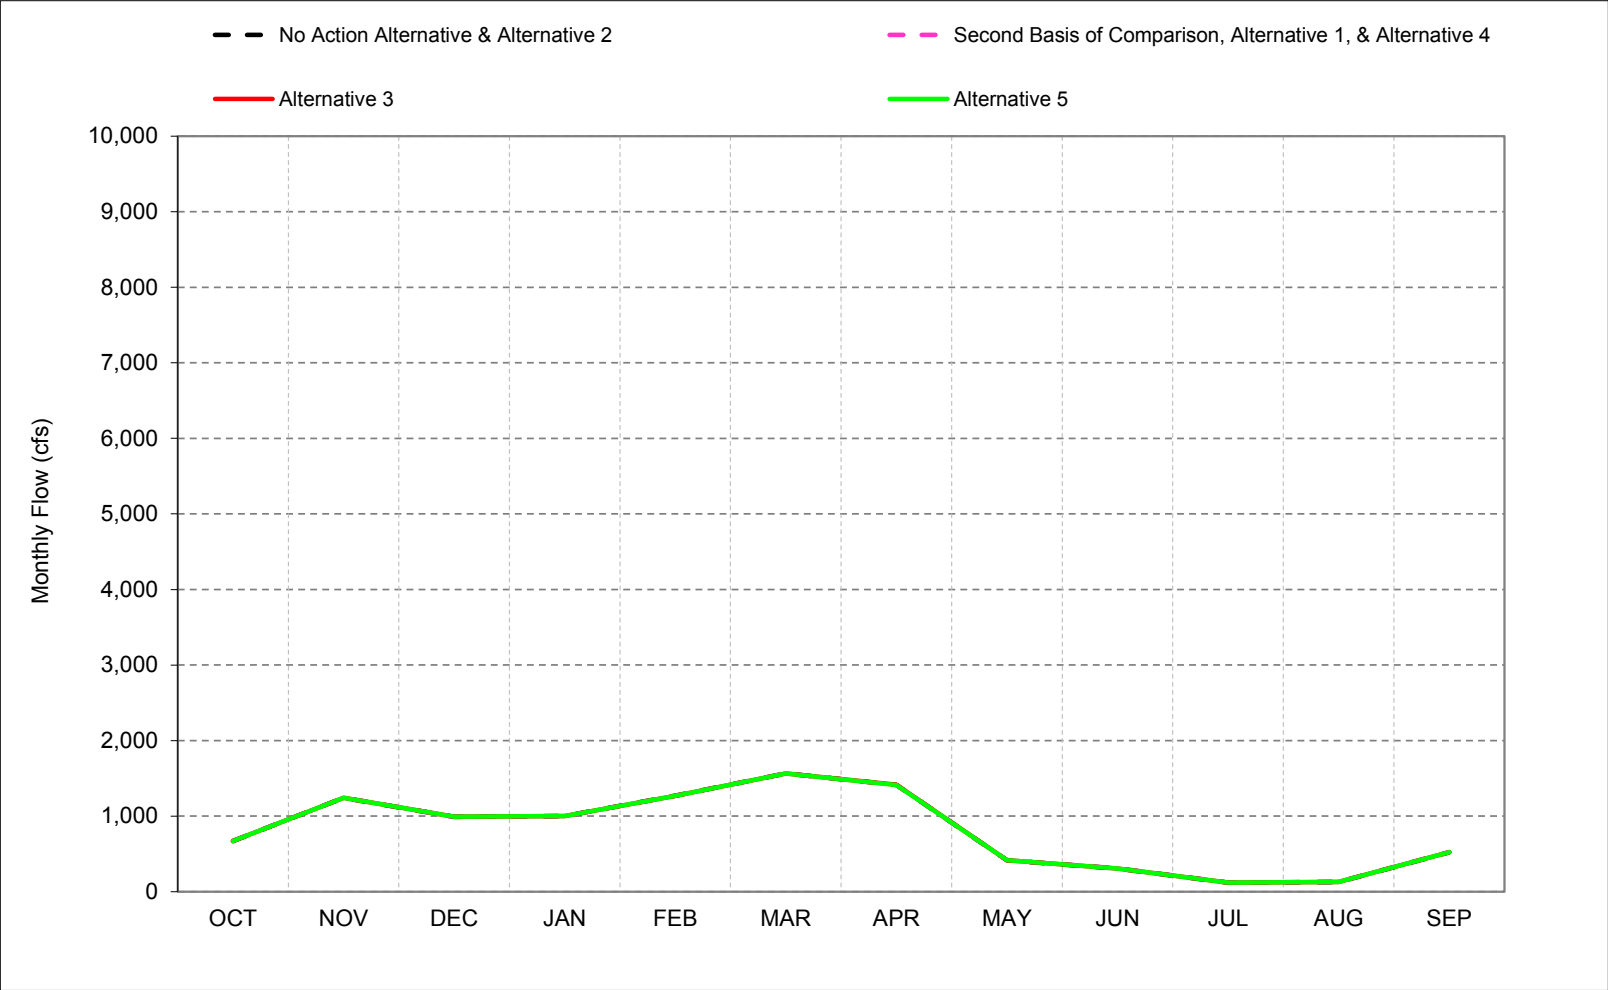


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-37-6. San Joaquin River d/s of Merced Confluence, Critical Year* Long-Term** Average Flow

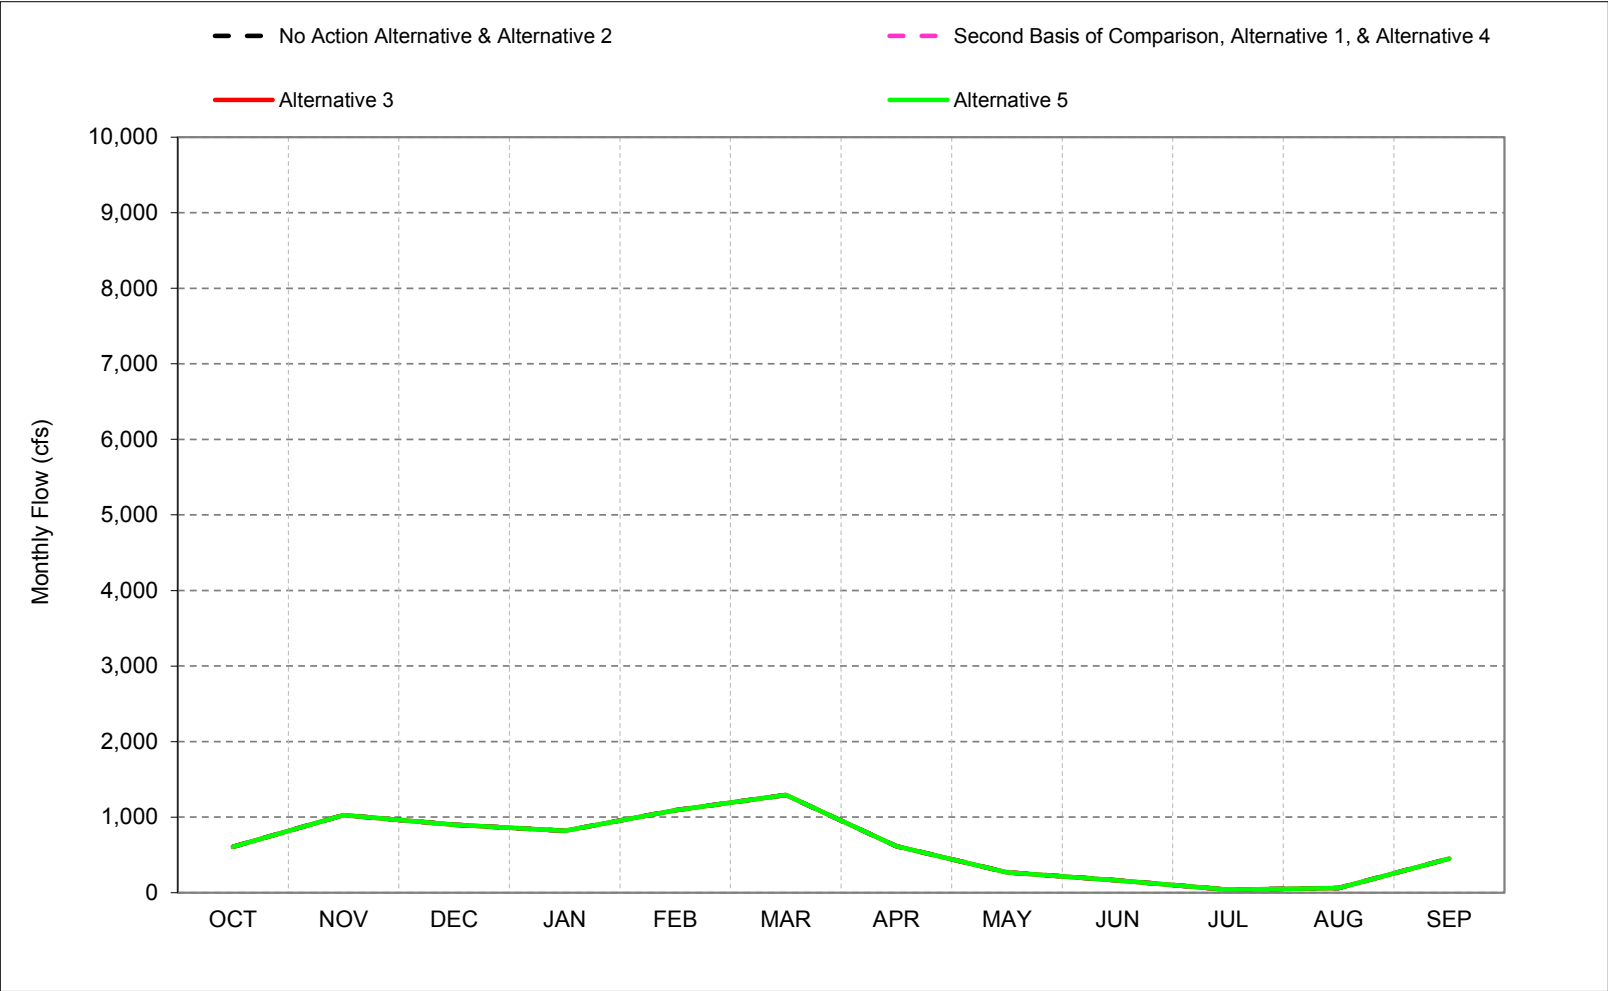

*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-37-1. San Joaquin River d/s of Merced Confluence, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	961	1,382	3,009	4,348	9,518	6,030	7,514	7,799	3,969	1,656	1,016	1,095
20%	792	1,288	1,482	2,766	4,303	3,738	4,295	2,720	2,395	825	906	994
30%	691	1,173	1,020	1,846	3,057	2,816	3,739	1,695	669	268	305	891
40%	660	1,114	970	1,219	2,220	2,088	3,329	786	494	215	206	604
50%	587	1,087	935	1,002	1,583	1,813	2,337	577	424	160	151	554
60%	559	1,064	902	926	1,421	1,608	1,761	458	371	147	133	535
70%	504	1,033	890	852	1,222	1,478	1,262	398	296	106	118	521
80%	486	1,004	870	819	1,116	1,378	857	321	219	34	74	495
90%	438	895	810	748	1,018	1,273	326	229	130	0	10	444
Long Term												
Full Simulation Period ^b	675	1,230	1,664	2,454	3,531	3,227	3,322	2,290	1,686	652	379	700
Water Year Types ^c												
Wet (23%)	780	1,541	3,334	6,096	8,323	7,527	7,783	7,422	5,839	2,267	935	1,095
Above Normal (24%)	688	1,177	1,261	2,146	3,796	2,934	3,719	1,544	798	328	453	780
Below Normal (10%)	581	1,161	1,896	1,433	1,865	1,766	2,281	562	473	177	157	532
Dry (16%)	672	1,243	991	1,000	1,270	1,565	1,414	416	307	120	129	522
Critical (27%)	609	1,028	901	819	1,092	1,293	615	270	163	39	60	451

Alternative 1												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	961	1,382	3,009	4,348	9,509	6,029	7,513	7,799	3,969	1,657	1,016	1,095
20%	792	1,288	1,482	2,766	4,303	3,738	4,295	2,720	2,395	826	906	994
30%	691	1,174	1,020	1,845	3,057	2,816	3,740	1,695	670	270	306	891
40%	660	1,114	970	1,219	2,212	2,088	3,330	787	496	217	208	605
50%	588	1,087	935	1,002	1,583	1,813	2,337	578	425	162	152	555
60%	559	1,064	902	926	1,421	1,608	1,762	459	372	148	135	536
70%	504	1,034	890	852	1,222	1,478	1,262	399	297	107	119	521
80%	486	1,004	870	819	1,116	1,378	858	321	219	34	74	495
90%	438	895	810	748	1,018	1,273	326	229	130	0	11	444
Long Term												
Full Simulation Period ^b	675	1,230	1,664	2,454	3,528	3,227	3,322	2,290	1,687	653	380	700
Water Year Types ^c												
Wet (23%)	780	1,541	3,334	6,094	8,315	7,525	7,782	7,421	5,839	2,267	936	1,096
Above Normal (24%)	688	1,177	1,261	2,146	3,795	2,934	3,720	1,544	799	329	454	781
Below Normal (10%)	581	1,161	1,896	1,433	1,865	1,766	2,282	564	475	179	158	533
Dry (16%)	672	1,243	991	1,000	1,270	1,565	1,414	417	308	121	130	523
Critical (27%)	609	1,029	901	819	1,092	1,293	615	270	164	40	61	451

Alternative 1 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0	0	0	0	-9	-1	-1	0	0	1	0	0
20%	0	0	0	0	0	0	0	1	0	1	0	0
30%	0	0	0	0	0	0	1	0	1	2	0	0
40%	0	0	0	0	-8	0	1	1	2	1	2	0
50%	0	0	0	0	0	0	0	1	1	2	1	1
60%	0	0	0	0	0	0	1	1	2	1	1	1
70%	0	0	0	0	0	0	0	1	1	1	2	0
80%	0	0	0	0	0	0	1	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	1	0
Long Term												
Full Simulation Period ^b	0	0	0	0	-2	0	0	0	1	1	1	0
Water Year Types ^c												
Wet (23%)	0	0	0	-1	-8	-2	0	-1	0	0	0	0
Above Normal (24%)	0	0	0	0	-2	0	0	0	1	1	1	0
Below Normal (10%)	0	0	0	0	0	0	1	1	2	2	2	1
Dry (16%)	0	0	0	0	0	0	1	1	1	2	1	1
Critical (27%)	0	0	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-37-2. San Joaquin River d/s of Merced Confluence, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	961	1,382	3,009	4,348	9,518	6,030	7,514	7,799	3,969	1,656	1,016	1,095
20%	792	1,288	1,482	2,766	4,303	3,738	4,295	2,720	2,395	825	906	994
30%	691	1,173	1,020	1,846	3,057	2,816	3,739	1,695	669	268	305	891
40%	660	1,114	970	1,219	2,220	2,088	3,329	786	494	215	206	604
50%	587	1,087	935	1,002	1,583	1,813	2,337	577	424	160	151	554
60%	559	1,064	902	926	1,421	1,608	1,761	458	371	147	133	535
70%	504	1,033	890	852	1,222	1,478	1,262	398	296	106	118	521
80%	486	1,004	870	819	1,116	1,378	857	321	219	34	74	495
90%	438	895	810	748	1,018	1,273	326	229	130	0	10	444
Long Term												
Full Simulation Period ^b	675	1,230	1,664	2,454	3,531	3,227	3,322	2,290	1,686	652	379	700
Water Year Types ^c												
Wet (23%)	780	1,541	3,334	6,096	8,323	7,527	7,783	7,422	5,839	2,267	935	1,095
Above Normal (24%)	688	1,177	1,261	2,146	3,796	2,934	3,719	1,544	798	328	453	780
Below Normal (10%)	581	1,161	1,896	1,433	1,865	1,766	2,281	562	473	177	157	532
Dry (16%)	672	1,243	991	1,000	1,270	1,565	1,414	416	307	120	129	522
Critical (27%)	609	1,028	901	819	1,092	1,293	615	270	163	39	60	451

Alternative 3												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	961	1,382	3,009	4,348	9,501	6,029	7,512	7,799	3,969	1,657	1,016	1,095
20%	792	1,288	1,482	2,766	4,303	3,738	4,295	2,721	2,395	827	907	994
30%	691	1,174	1,020	1,846	3,057	2,816	3,740	1,695	670	270	306	892
40%	660	1,114	970	1,219	2,213	2,088	3,330	787	495	216	208	605
50%	587	1,087	935	1,002	1,583	1,813	2,337	577	425	162	152	555
60%	559	1,064	902	926	1,421	1,608	1,762	459	372	147	135	536
70%	504	1,034	890	852	1,222	1,478	1,262	399	297	107	119	521
80%	486	1,004	870	819	1,116	1,378	858	321	219	34	74	495
90%	438	895	810	748	1,018	1,273	326	229	130	0	10	444
Long Term												
Full Simulation Period ^b	675	1,230	1,664	2,454	3,529	3,227	3,322	2,290	1,687	653	380	700
Water Year Types ^c												
Wet (23%)	780	1,541	3,334	6,095	8,317	7,525	7,782	7,421	5,839	2,267	936	1,096
Above Normal (24%)	688	1,177	1,261	2,146	3,795	2,934	3,720	1,544	799	329	453	781
Below Normal (10%)	581	1,161	1,897	1,433	1,865	1,766	2,282	564	474	179	158	533
Dry (16%)	672	1,243	991	1,000	1,270	1,565	1,414	417	308	121	129	523
Critical (27%)	609	1,028	901	819	1,092	1,293	615	270	163	40	60	451

Alternative 3 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0	0	0	0	-17	0	-2	0	0	1	0	0
20%	0	0	0	0	0	0	0	1	0	2	1	0
30%	0	0	0	0	0	0	1	0	1	2	1	1
40%	0	0	0	0	-7	0	1	1	1	1	2	0
50%	0	0	0	0	0	0	1	0	1	2	2	0
60%	0	0	0	0	0	0	1	1	1	0	1	1
70%	0	0	0	0	0	0	0	1	1	1	1	0
80%	0	0	0	0	0	0	1	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	-2	0	0	0	1	1	1	0
Water Year Types ^c												
Wet (23%)	0	0	0	-1	-7	-2	-1	-1	0	0	0	0
Above Normal (24%)	0	0	0	0	-1	0	0	0	1	1	1	0
Below Normal (10%)	0	0	0	0	0	0	1	1	1	2	1	1
Dry (16%)	0	0	0	0	0	0	0	1	1	1	1	0
Critical (27%)	0	0	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-37-3. San Joaquin River d/s of Merced Confluence, Monthly Flow

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	961	1,382	3,009	4,348	9,518	6,030	7,514	7,799	3,969	1,656	1,016	1,095
20%	792	1,288	1,482	2,766	4,303	3,738	4,295	2,720	2,395	825	906	994
30%	691	1,173	1,020	1,846	3,057	2,816	3,739	1,695	669	268	305	891
40%	660	1,114	970	1,219	2,220	2,088	3,329	786	494	215	206	604
50%	587	1,087	935	1,002	1,583	1,813	2,337	577	424	160	151	554
60%	559	1,064	902	926	1,421	1,608	1,761	458	371	147	133	535
70%	504	1,033	890	852	1,222	1,478	1,262	398	296	106	118	521
80%	486	1,004	870	819	1,116	1,378	857	321	219	34	74	495
90%	438	895	810	748	1,018	1,273	326	229	130	0	10	444
Long Term												
Full Simulation Period ^b	675	1,230	1,664	2,454	3,531	3,227	3,322	2,290	1,686	652	379	700
Water Year Types^c												
Wet (23%)	780	1,541	3,334	6,096	8,323	7,527	7,783	7,422	5,839	2,267	935	1,095
Above Normal (24%)	688	1,177	1,261	2,146	3,796	2,934	3,719	1,544	798	328	453	780
Below Normal (10%)	581	1,161	1,896	1,433	1,865	1,766	2,281	562	473	177	157	532
Dry (16%)	672	1,243	991	1,000	1,270	1,565	1,414	416	307	120	129	522
Critical (27%)	609	1,028	901	819	1,092	1,293	615	270	163	39	60	451

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	961	1,382	3,009	4,348	9,519	6,030	7,517	7,800	3,969	1,657	1,016	1,095
20%	792	1,288	1,482	2,766	4,303	3,738	4,295	2,719	2,395	825	906	994
30%	691	1,173	1,020	1,845	3,057	2,816	3,739	1,695	669	268	305	891
40%	660	1,114	970	1,219	2,220	2,088	3,329	786	494	215	207	604
50%	587	1,087	935	1,002	1,583	1,813	2,337	577	424	160	151	554
60%	559	1,064	902	926	1,421	1,608	1,761	458	371	147	133	535
70%	504	1,033	890	852	1,222	1,478	1,261	397	296	106	118	521
80%	486	1,004	870	819	1,116	1,378	857	320	219	34	74	495
90%	438	895	810	748	1,018	1,273	326	229	130	0	10	444
Long Term												
Full Simulation Period ^b	675	1,230	1,664	2,454	3,531	3,227	3,322	2,290	1,686	652	379	700
Water Year Types^c												
Wet (23%)	780	1,541	3,334	6,096	8,324	7,527	7,783	7,423	5,839	2,268	935	1,095
Above Normal (24%)	688	1,177	1,261	2,146	3,796	2,934	3,719	1,544	798	328	453	780
Below Normal (10%)	581	1,161	1,896	1,433	1,865	1,766	2,281	562	473	177	157	532
Dry (16%)	672	1,243	991	1,000	1,270	1,565	1,414	416	307	120	128	522
Critical (27%)	609	1,028	901	819	1,092	1,293	615	269	163	39	60	451

Alternative 5 minus No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	1	0	3	1	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types^c												
Wet (23%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (10%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (27%)	0	0	0	0	0	0	0	0	0	0	0	0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-37-4. San Joaquin River d/s of Merced Confluence, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	961	1,382	3,009	4,348	9,509	6,029	7,513	7,799	3,969	1,657	1,016	1,095
20%	792	1,288	1,482	2,766	4,303	3,738	4,295	2,720	2,395	826	906	994
30%	691	1,174	1,020	1,845	3,057	2,816	3,740	1,695	670	270	306	891
40%	660	1,114	970	1,219	2,212	2,088	3,330	787	496	217	208	605
50%	588	1,087	935	1,002	1,583	1,813	2,337	578	425	162	152	555
60%	559	1,064	902	926	1,421	1,608	1,762	459	372	148	135	536
70%	504	1,034	890	852	1,222	1,478	1,262	399	297	107	119	521
80%	486	1,004	870	819	1,116	1,378	858	321	219	34	74	495
90%	438	895	810	748	1,018	1,273	326	229	130	0	11	444
Long Term												
Full Simulation Period ^b	675	1,230	1,664	2,454	3,528	3,227	3,322	2,290	1,687	653	380	700
Water Year Types^c												
Wet (23%)	780	1,541	3,334	6,094	8,315	7,525	7,782	7,421	5,839	2,267	936	1,096
Above Normal (24%)	688	1,177	1,261	2,146	3,795	2,934	3,720	1,544	799	329	454	781
Below Normal (10%)	581	1,161	1,896	1,433	1,865	1,766	2,282	564	475	179	158	533
Dry (16%)	672	1,243	991	1,000	1,270	1,565	1,414	417	308	121	130	523
Critical (27%)	609	1,029	901	819	1,092	1,293	615	270	164	40	61	451

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	961	1,382	3,009	4,348	9,518	6,030	7,514	7,799	3,969	1,656	1,016	1,095
20%	792	1,288	1,482	2,766	4,303	3,738	4,295	2,720	2,395	825	906	994
30%	691	1,173	1,020	1,846	3,057	2,816	3,739	1,695	669	268	305	891
40%	660	1,114	970	1,219	2,220	2,088	3,329	786	494	215	206	604
50%	587	1,087	935	1,002	1,583	1,813	2,337	577	424	160	151	554
60%	559	1,064	902	926	1,421	1,608	1,761	458	371	147	133	535
70%	504	1,033	890	852	1,222	1,478	1,262	398	296	106	118	521
80%	486	1,004	870	819	1,116	1,378	857	321	219	34	74	495
90%	438	895	810	748	1,018	1,273	326	229	130	0	10	444
Long Term												
Full Simulation Period ^b	675	1,230	1,664	2,454	3,531	3,227	3,322	2,290	1,686	652	379	700
Water Year Types^c												
Wet (23%)	780	1,541	3,334	6,096	8,323	7,527	7,783	7,422	5,839	2,267	935	1,095
Above Normal (24%)	688	1,177	1,261	2,146	3,796	2,934	3,719	1,544	798	328	453	780
Below Normal (10%)	581	1,161	1,896	1,433	1,865	1,766	2,281	562	473	177	157	532
Dry (16%)	672	1,243	991	1,000	1,270	1,565	1,414	416	307	120	129	522
Critical (27%)	609	1,028	901	819	1,092	1,293	615	270	163	39	60	451

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	9	1	1	0	0	-1	0	0
20%	0	0	0	0	0	0	0	-1	0	-1	0	0
30%	0	0	0	0	0	0	0	-1	0	-1	-2	0
40%	0	0	0	0	8	0	-1	-1	-2	-1	-2	0
50%	0	0	0	0	0	0	0	-1	-1	-2	-1	-1
60%	0	0	0	0	0	0	-1	-1	-2	-1	-1	-1
70%	0	0	0	0	0	0	0	-1	-1	-1	-2	0
80%	0	0	0	0	0	0	-1	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	-1	0
Long Term												
Full Simulation Period ^b	0	0	0	0	2	0	0	0	-1	-1	-1	0
Water Year Types^c												
Wet (23%)	0	0	0	1	8	2	0	1	0	0	0	0
Above Normal (24%)	0	0	0	0	2	0	0	0	-1	-1	-1	0
Below Normal (10%)	0	0	0	0	0	0	-1	-1	-2	-2	-2	-1
Dry (16%)	0	0	0	0	0	0	-1	-1	-1	-2	-1	-1
Critical (27%)	0	0	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-37-5. San Joaquin River d/s of Merced Confluence, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	961	1,382	3,009	4,348	9,509	6,029	7,513	7,799	3,969	1,657	1,016	1,095
20%	792	1,288	1,482	2,766	4,303	3,738	4,295	2,720	2,395	826	906	994
30%	691	1,174	1,020	1,845	3,057	2,816	3,740	1,695	670	270	306	891
40%	660	1,114	970	1,219	2,212	2,088	3,330	787	496	217	208	605
50%	588	1,087	935	1,002	1,583	1,813	2,337	578	425	162	152	555
60%	559	1,064	902	926	1,421	1,608	1,762	459	372	148	135	536
70%	504	1,034	890	852	1,222	1,478	1,262	399	297	107	119	521
80%	486	1,004	870	819	1,116	1,378	858	321	219	34	74	495
90%	438	895	810	748	1,018	1,273	326	229	130	0	11	444
Long Term												
Full Simulation Period ^b	675	1,230	1,664	2,454	3,528	3,227	3,322	2,290	1,687	653	380	700
Water Year Types^c												
Wet (23%)	780	1,541	3,334	6,094	8,315	7,525	7,782	7,421	5,839	2,267	936	1,096
Above Normal (24%)	688	1,177	1,261	2,146	3,795	2,934	3,720	1,544	799	329	454	781
Below Normal (10%)	581	1,161	1,896	1,433	1,865	1,766	2,282	564	475	179	158	533
Dry (16%)	672	1,243	991	1,000	1,270	1,565	1,414	417	308	121	130	523
Critical (27%)	609	1,029	901	819	1,092	1,293	615	270	164	40	61	451

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	961	1,382	3,009	4,348	9,501	6,029	7,512	7,799	3,969	1,657	1,016	1,095
20%	792	1,288	1,482	2,766	4,303	3,738	4,295	2,721	2,395	827	907	994
30%	691	1,174	1,020	1,846	3,057	2,816	3,740	1,695	670	270	306	892
40%	660	1,114	970	1,219	2,213	2,088	3,330	787	495	216	208	605
50%	587	1,087	935	1,002	1,583	1,813	2,337	577	425	162	152	555
60%	559	1,064	902	926	1,421	1,608	1,762	459	372	147	135	536
70%	504	1,034	890	852	1,222	1,478	1,262	399	297	107	119	521
80%	486	1,004	870	819	1,116	1,378	858	321	219	34	74	495
90%	438	895	810	748	1,018	1,273	326	229	130	0	10	444
Long Term												
Full Simulation Period ^b	675	1,230	1,664	2,454	3,529	3,227	3,322	2,290	1,687	653	380	700
Water Year Types^c												
Wet (23%)	780	1,541	3,334	6,095	8,317	7,525	7,782	7,421	5,839	2,267	936	1,096
Above Normal (24%)	688	1,177	1,261	2,146	3,795	2,934	3,720	1,544	799	329	453	781
Below Normal (10%)	581	1,161	1,897	1,433	1,865	1,766	2,282	564	474	179	158	533
Dry (16%)	672	1,243	991	1,000	1,270	1,565	1,414	417	308	121	129	523
Critical (27%)	609	1,028	901	819	1,092	1,293	615	270	163	40	60	451

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	-8	0	-1	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	1	1	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	1	0	0	0	-1	-1	0	0
50%	0	0	0	0	0	0	0	-1	0	0	0	0
60%	0	0	0	0	0	0	0	0	-1	-1	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	-1	0	0
90%	0	0	0	0	0	0	0	0	0	0	-1	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types^c												
Wet (23%)	0	0	0	0	1	0	-1	0	0	0	0	0
Above Normal (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (10%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (27%)	0	0	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-37-6. San Joaquin River d/s of Merced Confluence, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	961	1,382	3,009	4,348	9,509	6,029	7,513	7,799	3,969	1,657	1,016	1,095
20%	792	1,288	1,482	2,766	4,303	3,738	4,295	2,720	2,395	826	906	994
30%	691	1,174	1,020	1,845	3,057	2,816	3,740	1,695	670	270	306	891
40%	660	1,114	970	1,219	2,212	2,088	3,330	787	496	217	208	605
50%	588	1,087	935	1,002	1,583	1,813	2,337	578	425	162	152	555
60%	559	1,064	902	926	1,421	1,608	1,762	459	372	148	135	536
70%	504	1,034	890	852	1,222	1,478	1,262	399	297	107	119	521
80%	486	1,004	870	819	1,116	1,378	858	321	219	34	74	495
90%	438	895	810	748	1,018	1,273	326	229	130	0	11	444
Long Term												
Full Simulation Period ^b	675	1,230	1,664	2,454	3,528	3,227	3,322	2,290	1,687	653	380	700
Water Year Types^c												
Wet (23%)	780	1,541	3,334	6,094	8,315	7,525	7,782	7,421	5,839	2,267	936	1,096
Above Normal (24%)	688	1,177	1,261	2,146	3,795	2,934	3,720	1,544	799	329	454	781
Below Normal (10%)	581	1,161	1,896	1,433	1,865	1,766	2,282	564	475	179	158	533
Dry (16%)	672	1,243	991	1,000	1,270	1,565	1,414	417	308	121	130	523
Critical (27%)	609	1,029	901	819	1,092	1,293	615	270	164	40	61	451

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	961	1,382	3,009	4,348	9,519	6,030	7,517	7,800	3,969	1,657	1,016	1,095
20%	792	1,288	1,482	2,766	4,303	3,738	4,295	2,719	2,395	825	906	994
30%	691	1,173	1,020	1,845	3,057	2,816	3,739	1,695	669	268	305	891
40%	660	1,114	970	1,219	2,220	2,088	3,329	786	494	215	207	604
50%	587	1,087	935	1,002	1,583	1,813	2,337	577	424	160	151	554
60%	559	1,064	902	926	1,421	1,608	1,761	458	371	147	133	535
70%	504	1,033	890	852	1,222	1,478	1,261	397	296	106	118	521
80%	486	1,004	870	819	1,116	1,378	857	320	219	34	74	495
90%	438	895	810	748	1,018	1,273	326	229	130	0	10	444
Long Term												
Full Simulation Period ^b	675	1,230	1,664	2,454	3,531	3,227	3,322	2,290	1,686	652	379	700
Water Year Types^c												
Wet (23%)	780	1,541	3,334	6,096	8,324	7,527	7,783	7,423	5,839	2,268	935	1,095
Above Normal (24%)	688	1,177	1,261	2,146	3,796	2,934	3,719	1,544	798	328	453	780
Below Normal (10%)	581	1,161	1,896	1,433	1,865	1,766	2,281	562	473	177	157	532
Dry (16%)	672	1,243	991	1,000	1,270	1,565	1,414	416	307	120	128	522
Critical (27%)	609	1,028	901	819	1,092	1,293	615	269	163	39	60	451

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	10	1	4	1	0	-1	0	0
20%	0	0	0	0	0	0	0	-1	0	-1	0	0
30%	0	0	0	0	0	0	0	-1	0	-2	0	-1
40%	0	0	0	0	7	0	-1	-1	-2	-1	-2	0
50%	0	0	0	0	0	0	0	-1	-1	-2	-1	-1
60%	0	0	0	0	0	0	-1	-1	-2	-1	-1	-1
70%	0	0	0	0	0	0	0	-1	-1	-1	-2	0
80%	0	0	0	0	0	0	-1	-1	0	0	0	0
90%	0	0	0	0	0	0	0	-1	0	0	-1	0
Long Term												
Full Simulation Period ^b	0	0	0	0	2	0	0	0	-1	-1	-1	0
Water Year Types^c												
Wet (23%)	0	0	0	1	8	2	0	2	1	0	0	0
Above Normal (24%)	0	0	0	0	2	0	0	0	-1	-1	-1	0
Below Normal (10%)	0	0	0	0	0	0	-1	-1	-2	-2	-2	-1
Dry (16%)	0	0	0	0	0	0	-1	-1	-1	-2	-1	-1
Critical (27%)	0	0	0	0	0	0	0	-1	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

1 **C.38. San Joaquin River Restoration Flow**


Figure C-38-1. San Joaquin River Restoration Flows, Long-Term* Average Flow

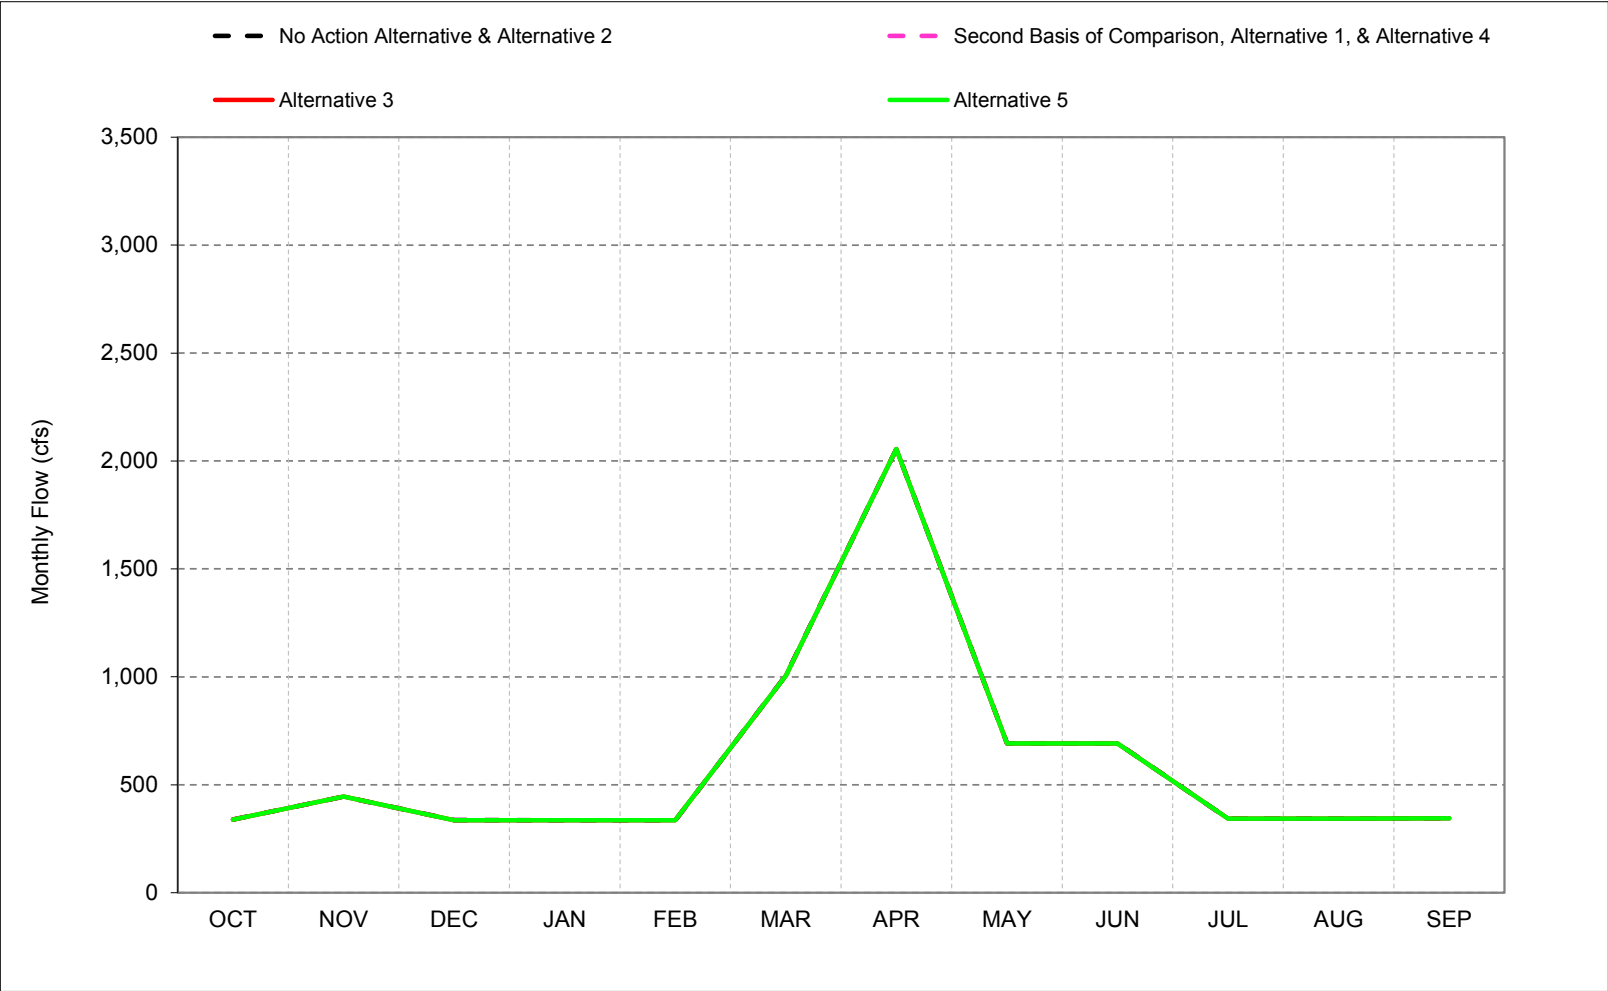

*Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-38-2. San Joaquin River Restoration Flows, Wet Year* Long-Term** Average Flow

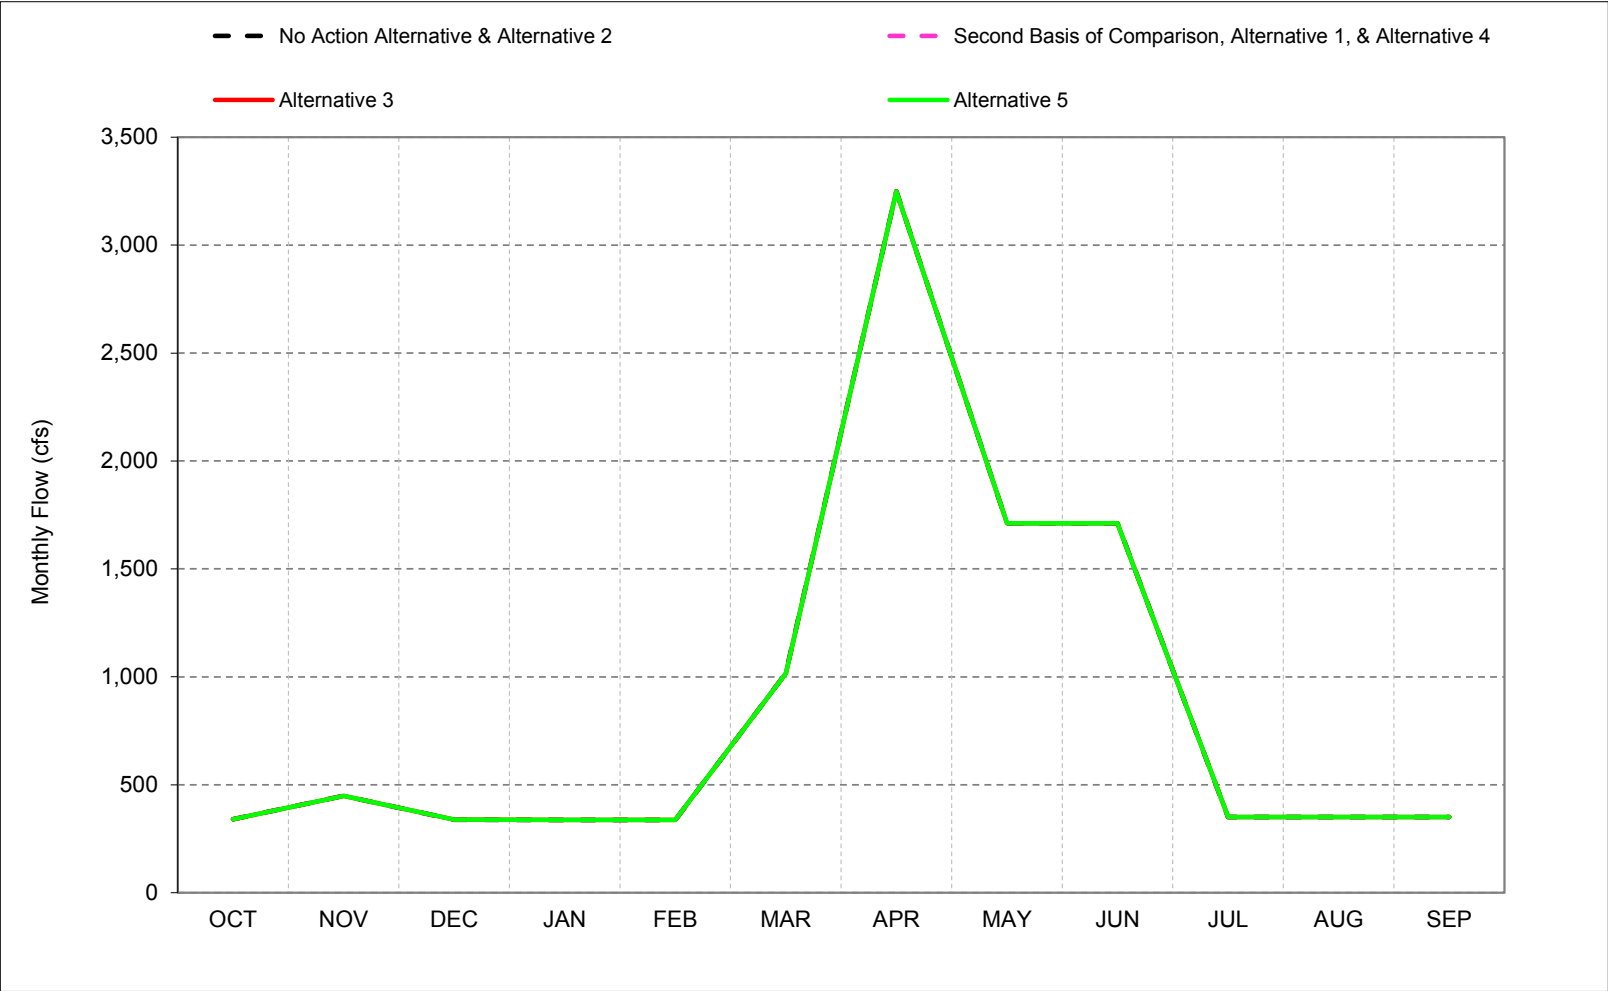


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-38-3. San Joaquin River Restoration Flows, Above Normal Year* Long-Term** Average Flow

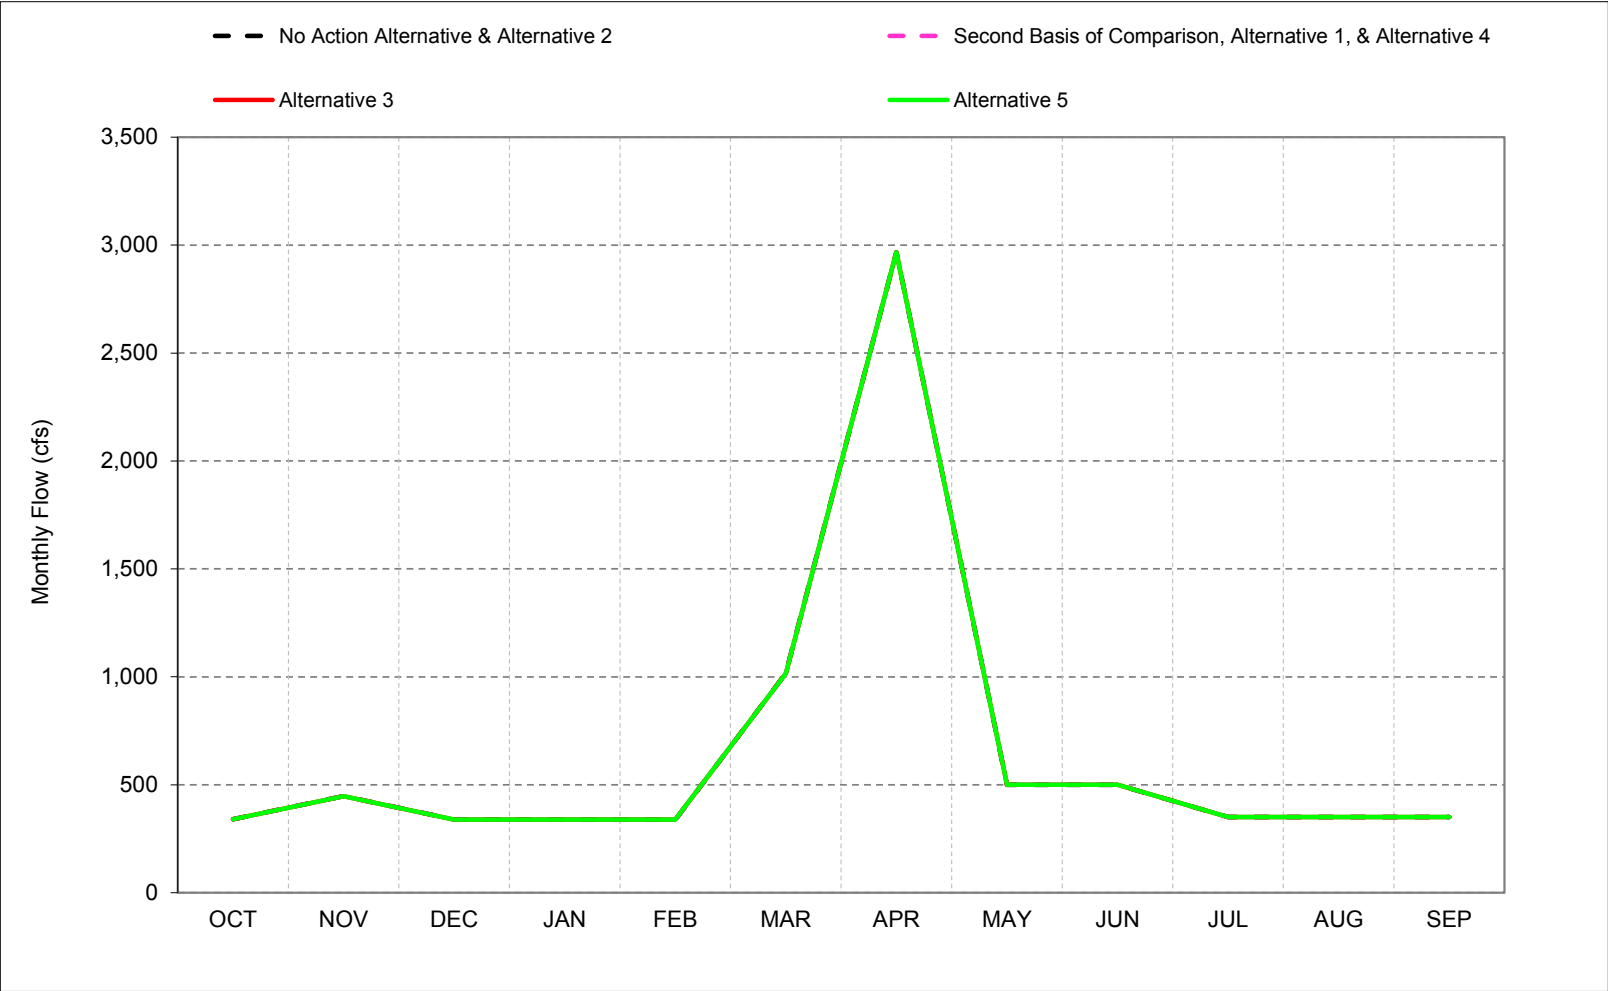


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-38-4. San Joaquin River Restoration Flows, Below Normal Year* Long-Term** Average Flow

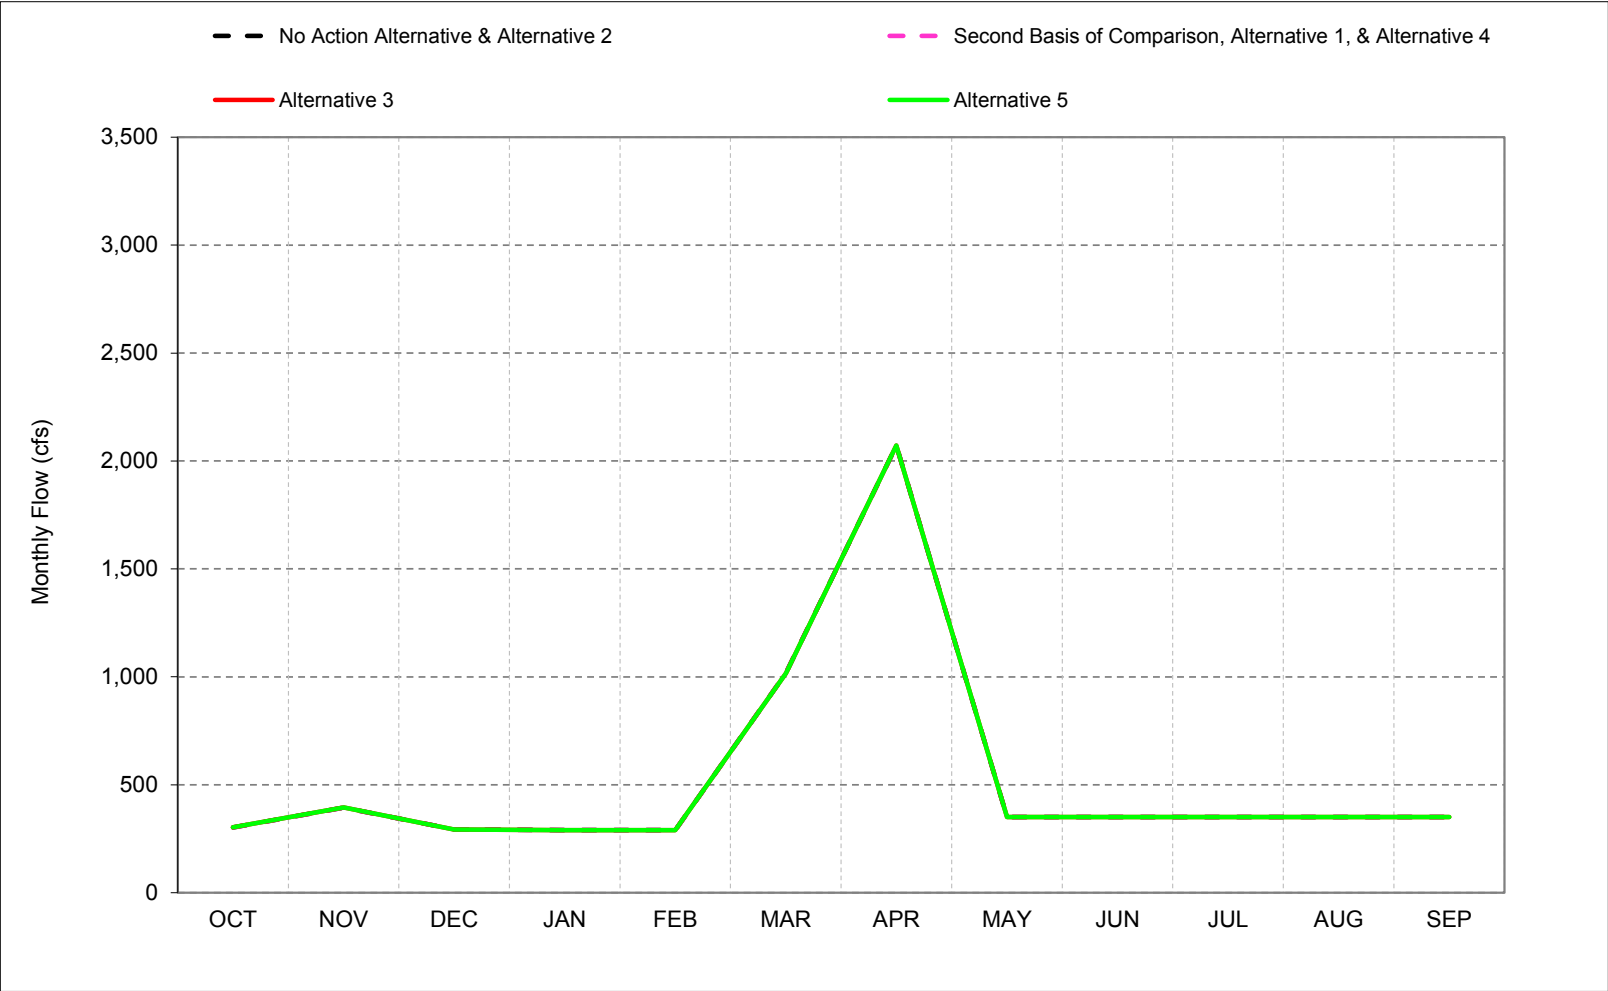


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-38-5. San Joaquin River Restoration Flows, Dry Year* Long-Term** Average Flow

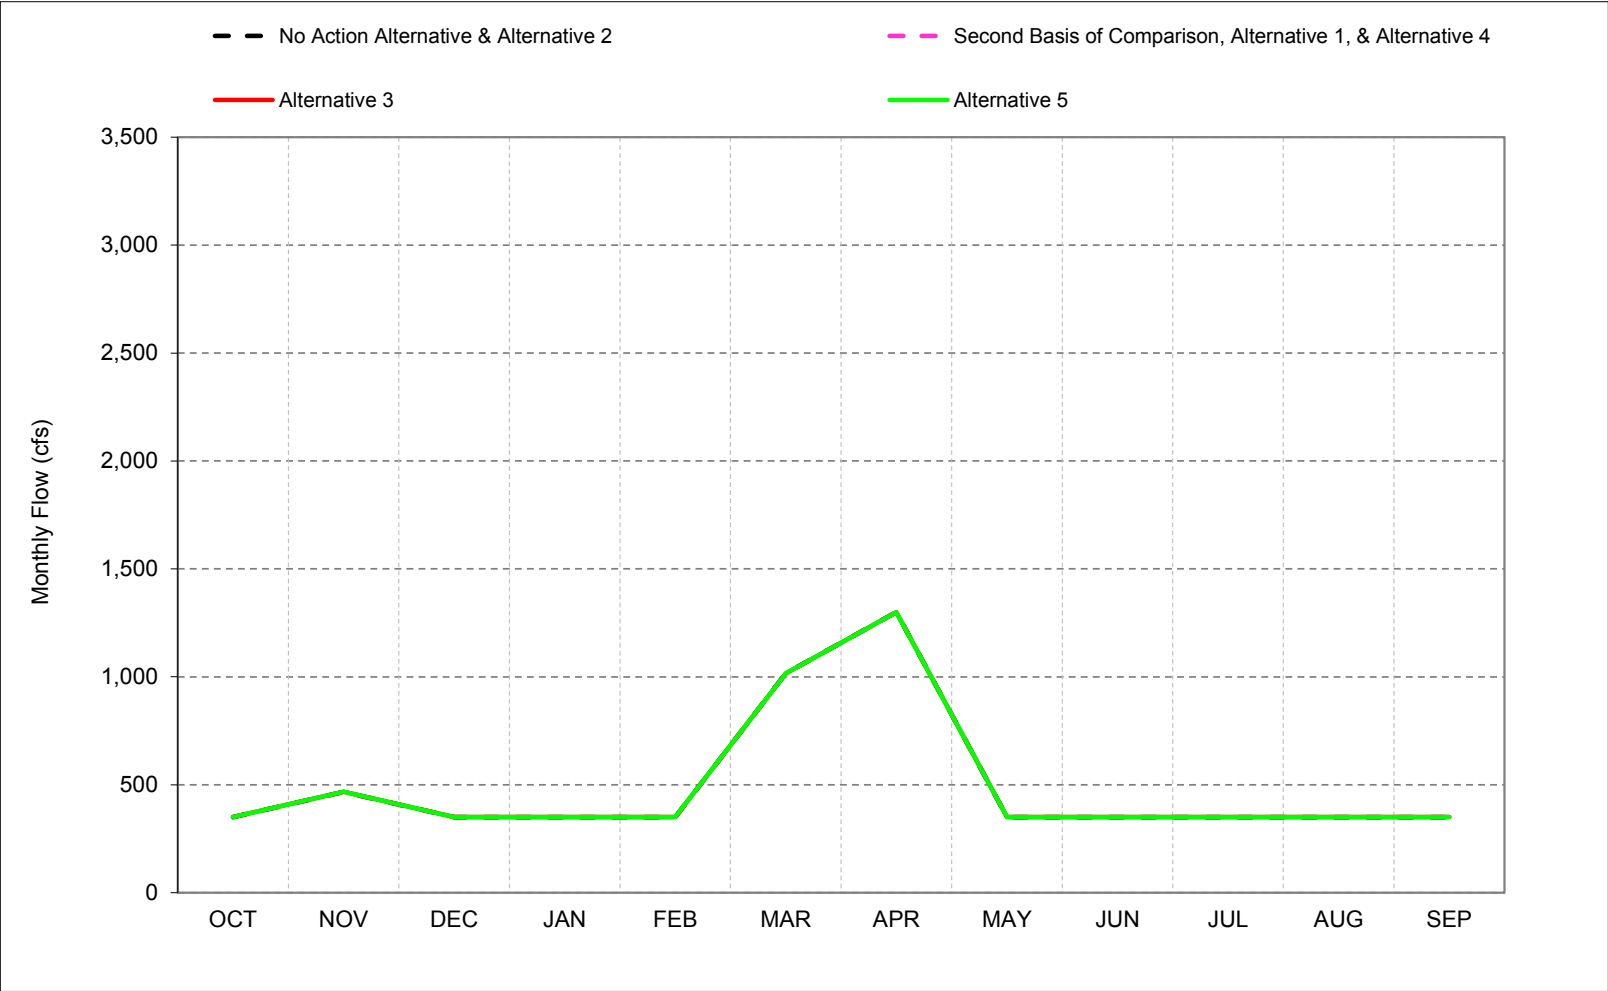


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-38-6. San Joaquin River Restoration Flows, Critical Year* Long-Term** Average Flow

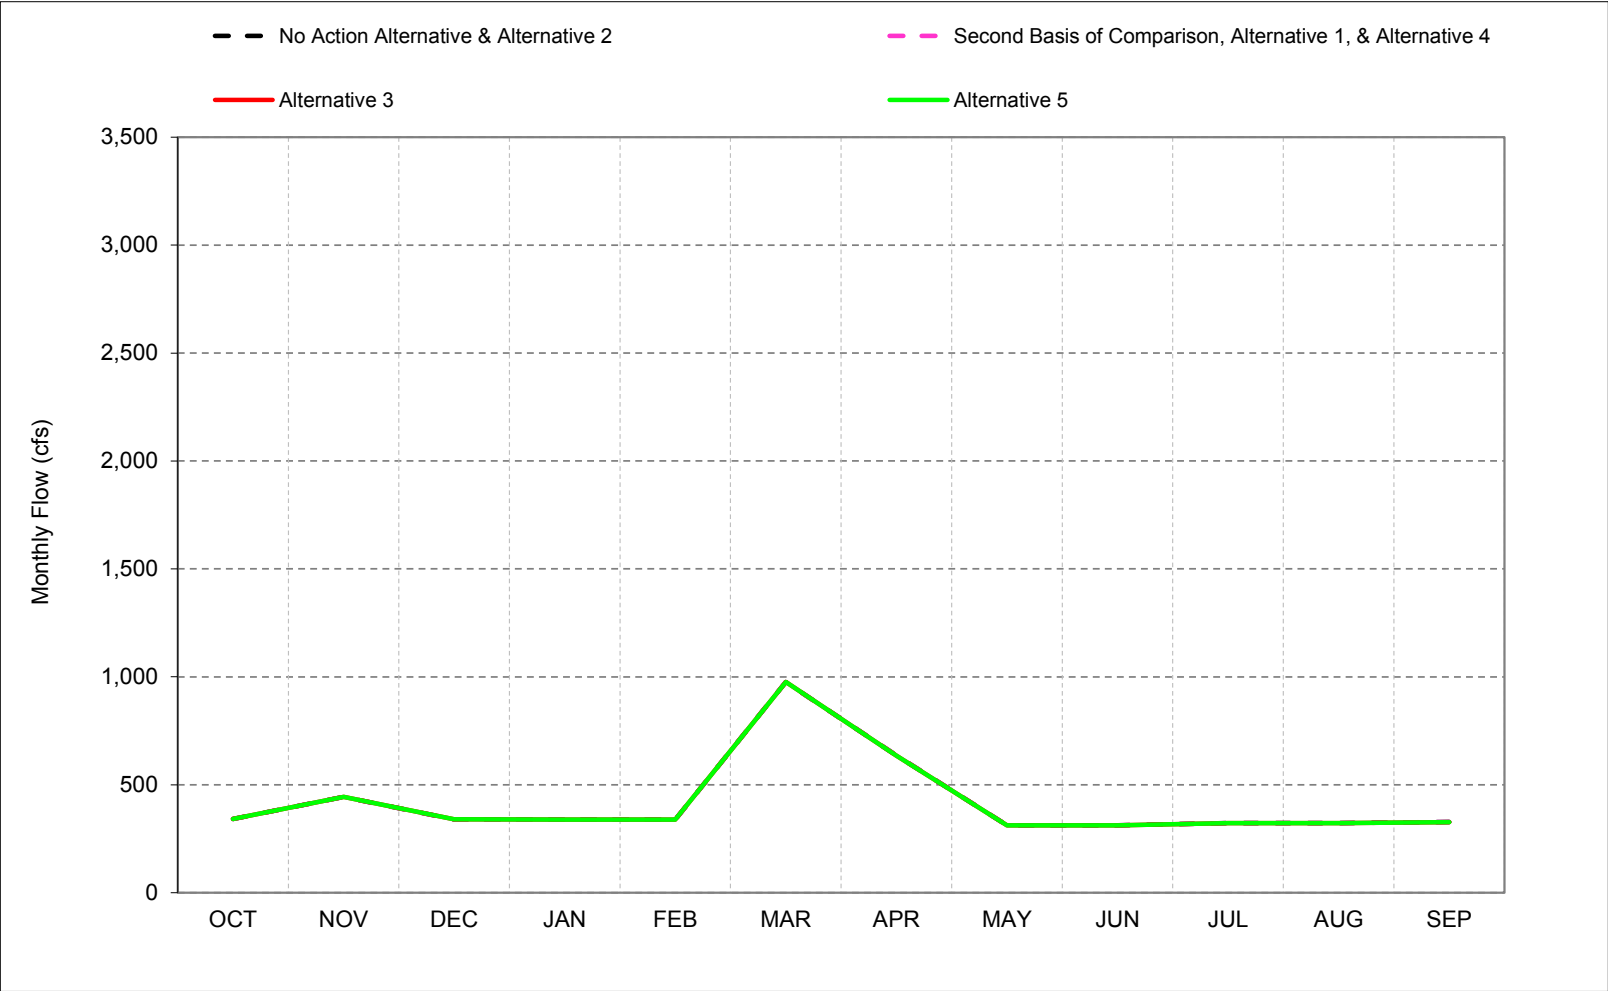

*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-38-1. San Joaquin River Restoration Flows, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	350	467	350	350	350	1,016	3,249	2,000	2,000	350	350	350
20%	350	467	350	350	350	1,016	3,249	771	771	350	350	350
30%	350	467	350	350	350	1,016	3,249	435	435	350	350	350
40%	350	467	350	350	350	1,016	2,970	350	350	350	350	350
50%	350	467	350	350	350	1,016	2,008	350	350	350	350	350
60%	350	467	350	350	350	1,016	1,543	350	350	350	350	350
70%	350	467	350	350	350	1,016	1,281	350	350	350	350	350
80%	350	467	350	350	350	1,016	817	350	350	350	350	350
90%	350	467	350	350	350	1,016	388	350	350	350	350	350
Long Term												
Full Simulation Period ^b	338	445	336	335	335	1,005	2,055	692	692	343	343	344
Water Year Types^c												
Wet (23%)	340	449	338	337	337	1,016	3,249	1,711	1,711	350	350	350
Above Normal (24%)	341	447	339	338	338	1,016	2,967	500	500	350	350	350
Below Normal (10%)	303	394	293	290	290	1,016	2,071	350	350	350	350	350
Dry (16%)	350	467	350	350	350	1,016	1,300	350	350	350	350	350
Critical (27%)	341	444	340	339	339	976	636	312	312	323	323	327

Alternative 1												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	350	467	350	350	350	1,016	3,249	2,000	2,000	350	350	350
20%	350	467	350	350	350	1,016	3,249	771	771	350	350	350
30%	350	467	350	350	350	1,016	3,249	435	435	350	350	350
40%	350	467	350	350	350	1,016	2,970	350	350	350	350	350
50%	350	467	350	350	350	1,016	2,008	350	350	350	350	350
60%	350	467	350	350	350	1,016	1,543	350	350	350	350	350
70%	350	467	350	350	350	1,016	1,281	350	350	350	350	350
80%	350	467	350	350	350	1,016	817	350	350	350	350	350
90%	350	467	350	350	350	1,016	388	350	350	350	350	350
Long Term												
Full Simulation Period ^b	338	445	336	335	335	1,005	2,055	692	692	343	343	344
Water Year Types^c												
Wet (23%)	340	449	338	337	337	1,016	3,249	1,711	1,711	350	350	350
Above Normal (24%)	341	447	339	338	338	1,016	2,967	500	500	350	350	350
Below Normal (10%)	303	394	293	290	290	1,016	2,071	350	350	350	350	350
Dry (16%)	350	467	350	350	350	1,016	1,300	350	350	350	350	350
Critical (27%)	341	444	340	339	339	976	636	312	312	323	323	327

Alternative 1 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types^c												
Wet (23%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (10%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (27%)	0	0	0	0	0	0	0	0	0	0	0	0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-38-2. San Joaquin River Restoration Flows, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	350	467	350	350	350	1,016	3,249	2,000	2,000	350	350	350
20%	350	467	350	350	350	1,016	3,249	771	771	350	350	350
30%	350	467	350	350	350	1,016	3,249	435	435	350	350	350
40%	350	467	350	350	350	1,016	2,970	350	350	350	350	350
50%	350	467	350	350	350	1,016	2,008	350	350	350	350	350
60%	350	467	350	350	350	1,016	1,543	350	350	350	350	350
70%	350	467	350	350	350	1,016	1,281	350	350	350	350	350
80%	350	467	350	350	350	1,016	817	350	350	350	350	350
90%	350	467	350	350	350	1,016	388	350	350	350	350	350
Long Term												
Full Simulation Period ^b	338	445	336	335	335	1,005	2,055	692	692	343	343	344
Water Year Types ^c												
Wet (23%)	340	449	338	337	337	1,016	3,249	1,711	1,711	350	350	350
Above Normal (24%)	341	447	339	338	338	1,016	2,967	500	500	350	350	350
Below Normal (10%)	303	394	293	290	290	1,016	2,071	350	350	350	350	350
Dry (16%)	350	467	350	350	350	1,016	1,300	350	350	350	350	350
Critical (27%)	341	444	340	339	339	976	636	312	312	323	323	327

Alternative 3												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	350	467	350	350	350	1,016	3,249	2,000	2,000	350	350	350
20%	350	467	350	350	350	1,016	3,249	771	771	350	350	350
30%	350	467	350	350	350	1,016	3,249	435	435	350	350	350
40%	350	467	350	350	350	1,016	2,970	350	350	350	350	350
50%	350	467	350	350	350	1,016	2,008	350	350	350	350	350
60%	350	467	350	350	350	1,016	1,543	350	350	350	350	350
70%	350	467	350	350	350	1,016	1,281	350	350	350	350	350
80%	350	467	350	350	350	1,016	817	350	350	350	350	350
90%	350	467	350	350	350	1,016	388	350	350	350	350	350
Long Term												
Full Simulation Period ^b	338	445	336	335	335	1,005	2,055	692	692	343	343	344
Water Year Types ^c												
Wet (23%)	340	449	338	337	337	1,016	3,249	1,711	1,711	350	350	350
Above Normal (24%)	341	447	339	338	338	1,016	2,967	500	500	350	350	350
Below Normal (10%)	303	394	293	290	290	1,016	2,071	350	350	350	350	350
Dry (16%)	350	467	350	350	350	1,016	1,300	350	350	350	350	350
Critical (27%)	341	444	340	339	339	976	636	312	312	323	323	327

Alternative 3 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types ^c												
Wet (23%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (10%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (27%)	0	0	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-38-3. San Joaquin River Restoration Flows, Monthly Flow

No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	350	467	350	350	350	1,016	3,249	2,000	2,000	350	350	350
20%	350	467	350	350	350	1,016	3,249	771	771	350	350	350
30%	350	467	350	350	350	1,016	3,249	435	435	350	350	350
40%	350	467	350	350	350	1,016	2,970	350	350	350	350	350
50%	350	467	350	350	350	1,016	2,008	350	350	350	350	350
60%	350	467	350	350	350	1,016	1,543	350	350	350	350	350
70%	350	467	350	350	350	1,016	1,281	350	350	350	350	350
80%	350	467	350	350	350	1,016	817	350	350	350	350	350
90%	350	467	350	350	350	1,016	388	350	350	350	350	350
Long Term												
Full Simulation Period ^b	338	445	336	335	335	1,005	2,055	692	692	343	343	344
Water Year Types ^c												
Wet (23%)	340	449	338	337	337	1,016	3,249	1,711	1,711	350	350	350
Above Normal (24%)	341	447	339	338	338	1,016	2,967	500	500	350	350	350
Below Normal (10%)	303	394	293	290	290	1,016	2,071	350	350	350	350	350
Dry (16%)	350	467	350	350	350	1,016	1,300	350	350	350	350	350
Critical (27%)	341	444	340	339	339	976	636	312	312	323	323	327

Alternative 5												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	350	467	350	350	350	1,016	3,249	2,000	2,000	350	350	350
20%	350	467	350	350	350	1,016	3,249	771	771	350	350	350
30%	350	467	350	350	350	1,016	3,249	435	435	350	350	350
40%	350	467	350	350	350	1,016	2,970	350	350	350	350	350
50%	350	467	350	350	350	1,016	2,008	350	350	350	350	350
60%	350	467	350	350	350	1,016	1,543	350	350	350	350	350
70%	350	467	350	350	350	1,016	1,281	350	350	350	350	350
80%	350	467	350	350	350	1,016	817	350	350	350	350	350
90%	350	467	350	350	350	1,016	388	350	350	350	350	350
Long Term												
Full Simulation Period ^b	338	445	336	335	335	1,005	2,055	692	692	343	343	344
Water Year Types ^c												
Wet (23%)	340	449	338	337	337	1,016	3,249	1,711	1,711	350	350	350
Above Normal (24%)	341	447	339	338	338	1,016	2,967	500	500	350	350	350
Below Normal (10%)	303	394	293	290	290	1,016	2,071	350	350	350	350	350
Dry (16%)	350	467	350	350	350	1,016	1,300	350	350	350	350	350
Critical (27%)	341	444	340	339	339	976	636	312	312	323	323	327

Alternative 5 minus No Action Alternative												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types ^c												
Wet (23%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (10%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (27%)	0	0	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-38-4. San Joaquin River Restoration Flows, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	350	467	350	350	350	1,016	3,249	2,000	2,000	350	350	350
20%	350	467	350	350	350	1,016	3,249	771	771	350	350	350
30%	350	467	350	350	350	1,016	3,249	435	435	350	350	350
40%	350	467	350	350	350	1,016	2,970	350	350	350	350	350
50%	350	467	350	350	350	1,016	2,008	350	350	350	350	350
60%	350	467	350	350	350	1,016	1,543	350	350	350	350	350
70%	350	467	350	350	350	1,016	1,281	350	350	350	350	350
80%	350	467	350	350	350	1,016	817	350	350	350	350	350
90%	350	467	350	350	350	1,016	388	350	350	350	350	350
Long Term												
Full Simulation Period ^b	338	445	336	335	335	1,005	2,055	692	692	343	343	344
Water Year Types^c												
Wet (23%)	340	449	338	337	337	1,016	3,249	1,711	1,711	350	350	350
Above Normal (24%)	341	447	339	338	338	1,016	2,967	500	500	350	350	350
Below Normal (10%)	303	394	293	290	290	1,016	2,071	350	350	350	350	350
Dry (16%)	350	467	350	350	350	1,016	1,300	350	350	350	350	350
Critical (27%)	341	444	340	339	339	976	636	312	312	323	323	327

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	350	467	350	350	350	1,016	3,249	2,000	2,000	350	350	350
20%	350	467	350	350	350	1,016	3,249	771	771	350	350	350
30%	350	467	350	350	350	1,016	3,249	435	435	350	350	350
40%	350	467	350	350	350	1,016	2,970	350	350	350	350	350
50%	350	467	350	350	350	1,016	2,008	350	350	350	350	350
60%	350	467	350	350	350	1,016	1,543	350	350	350	350	350
70%	350	467	350	350	350	1,016	1,281	350	350	350	350	350
80%	350	467	350	350	350	1,016	817	350	350	350	350	350
90%	350	467	350	350	350	1,016	388	350	350	350	350	350
Long Term												
Full Simulation Period ^b	338	445	336	335	335	1,005	2,055	692	692	343	343	344
Water Year Types^c												
Wet (23%)	340	449	338	337	337	1,016	3,249	1,711	1,711	350	350	350
Above Normal (24%)	341	447	339	338	338	1,016	2,967	500	500	350	350	350
Below Normal (10%)	303	394	293	290	290	1,016	2,071	350	350	350	350	350
Dry (16%)	350	467	350	350	350	1,016	1,300	350	350	350	350	350
Critical (27%)	341	444	340	339	339	976	636	312	312	323	323	327

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types^c												
Wet (23%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (10%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (27%)	0	0	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-38-5. San Joaquin River Restoration Flows, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	350	467	350	350	350	1,016	3,249	2,000	2,000	350	350	350
20%	350	467	350	350	350	1,016	3,249	771	771	350	350	350
30%	350	467	350	350	350	1,016	3,249	435	435	350	350	350
40%	350	467	350	350	350	1,016	2,970	350	350	350	350	350
50%	350	467	350	350	350	1,016	2,008	350	350	350	350	350
60%	350	467	350	350	350	1,016	1,543	350	350	350	350	350
70%	350	467	350	350	350	1,016	1,281	350	350	350	350	350
80%	350	467	350	350	350	1,016	817	350	350	350	350	350
90%	350	467	350	350	350	1,016	388	350	350	350	350	350
Long Term												
Full Simulation Period ^b	338	445	336	335	335	1,005	2,055	692	692	343	343	344
Water Year Types ^c												
Wet (23%)	340	449	338	337	337	1,016	3,249	1,711	1,711	350	350	350
Above Normal (24%)	341	447	339	338	338	1,016	2,967	500	500	350	350	350
Below Normal (10%)	303	394	293	290	290	1,016	2,071	350	350	350	350	350
Dry (16%)	350	467	350	350	350	1,016	1,300	350	350	350	350	350
Critical (27%)	341	444	340	339	339	976	636	312	312	323	323	327

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	350	467	350	350	350	1,016	3,249	2,000	2,000	350	350	350
20%	350	467	350	350	350	1,016	3,249	771	771	350	350	350
30%	350	467	350	350	350	1,016	3,249	435	435	350	350	350
40%	350	467	350	350	350	1,016	2,970	350	350	350	350	350
50%	350	467	350	350	350	1,016	2,008	350	350	350	350	350
60%	350	467	350	350	350	1,016	1,543	350	350	350	350	350
70%	350	467	350	350	350	1,016	1,281	350	350	350	350	350
80%	350	467	350	350	350	1,016	817	350	350	350	350	350
90%	350	467	350	350	350	1,016	388	350	350	350	350	350
Long Term												
Full Simulation Period ^b	338	445	336	335	335	1,005	2,055	692	692	343	343	344
Water Year Types ^c												
Wet (23%)	340	449	338	337	337	1,016	3,249	1,711	1,711	350	350	350
Above Normal (24%)	341	447	339	338	338	1,016	2,967	500	500	350	350	350
Below Normal (10%)	303	394	293	290	290	1,016	2,071	350	350	350	350	350
Dry (16%)	350	467	350	350	350	1,016	1,300	350	350	350	350	350
Critical (27%)	341	444	340	339	339	976	636	312	312	323	323	327

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types ^c												
Wet (23%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (10%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (27%)	0	0	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-38-6. San Joaquin River Restoration Flows, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	350	467	350	350	350	1,016	3,249	2,000	2,000	350	350	350
20%	350	467	350	350	350	1,016	3,249	771	771	350	350	350
30%	350	467	350	350	350	1,016	3,249	435	435	350	350	350
40%	350	467	350	350	350	1,016	2,970	350	350	350	350	350
50%	350	467	350	350	350	1,016	2,008	350	350	350	350	350
60%	350	467	350	350	350	1,016	1,543	350	350	350	350	350
70%	350	467	350	350	350	1,016	1,281	350	350	350	350	350
80%	350	467	350	350	350	1,016	817	350	350	350	350	350
90%	350	467	350	350	350	1,016	388	350	350	350	350	350
Long Term												
Full Simulation Period ^b	338	445	336	335	335	1,005	2,055	692	692	343	343	344
Water Year Types^c												
Wet (23%)	340	449	338	337	337	1,016	3,249	1,711	1,711	350	350	350
Above Normal (24%)	341	447	339	338	338	1,016	2,967	500	500	350	350	350
Below Normal (10%)	303	394	293	290	290	1,016	2,071	350	350	350	350	350
Dry (16%)	350	467	350	350	350	1,016	1,300	350	350	350	350	350
Critical (27%)	341	444	340	339	339	976	636	312	312	323	323	327

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	350	467	350	350	350	1,016	3,249	2,000	2,000	350	350	350
20%	350	467	350	350	350	1,016	3,249	771	771	350	350	350
30%	350	467	350	350	350	1,016	3,249	435	435	350	350	350
40%	350	467	350	350	350	1,016	2,970	350	350	350	350	350
50%	350	467	350	350	350	1,016	2,008	350	350	350	350	350
60%	350	467	350	350	350	1,016	1,543	350	350	350	350	350
70%	350	467	350	350	350	1,016	1,281	350	350	350	350	350
80%	350	467	350	350	350	1,016	817	350	350	350	350	350
90%	350	467	350	350	350	1,016	388	350	350	350	350	350
Long Term												
Full Simulation Period ^b	338	445	336	335	335	1,005	2,055	692	692	343	343	344
Water Year Types^c												
Wet (23%)	340	449	338	337	337	1,016	3,249	1,711	1,711	350	350	350
Above Normal (24%)	341	447	339	338	338	1,016	2,967	500	500	350	350	350
Below Normal (10%)	303	394	293	290	290	1,016	2,071	350	350	350	350	350
Dry (16%)	350	467	350	350	350	1,016	1,300	350	350	350	350	350
Critical (27%)	341	444	340	339	339	976	636	312	312	323	323	327

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types^c												
Wet (23%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (10%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (27%)	0	0	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

1 **C.39. San Joaquin River Flow at Vernalis minus San Joaquin**
2 **River Flow downstream of Merced River Confluence**


Figure C-39-1. San Joaquin River at Vernalis - Joaquin River d/s of Merced Confluence, Long-Term* Average Flow

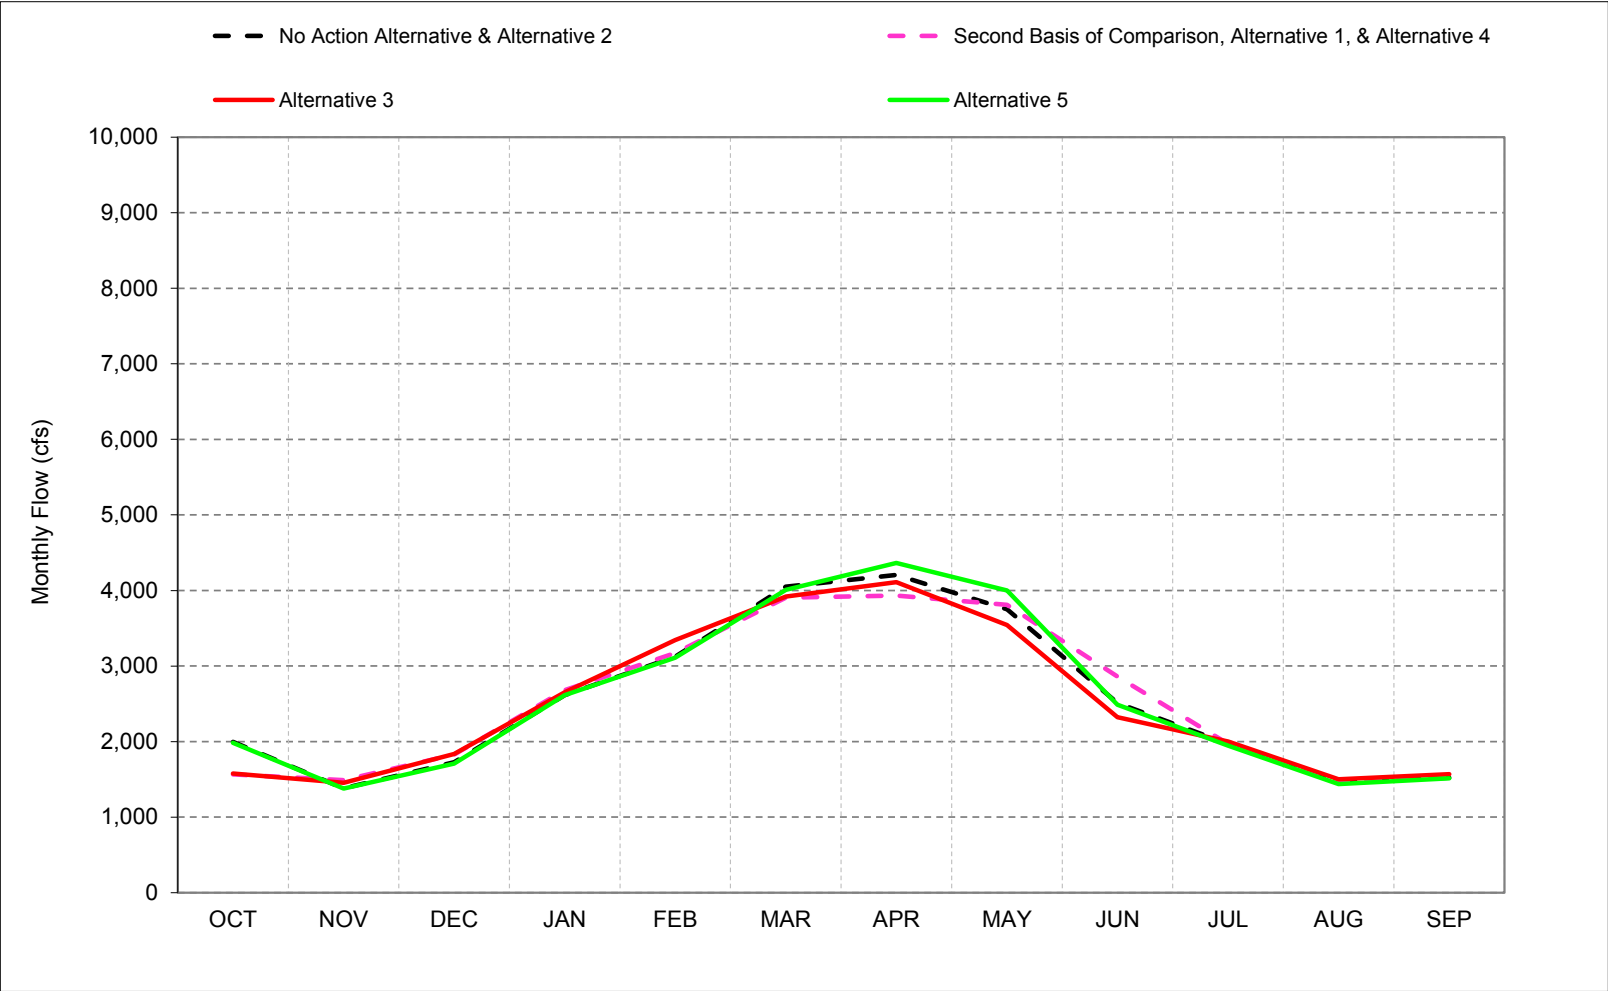

*Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-39-2. San Joaquin River at Vernalis - Joaquin River d/s of Merced Confluence, Wet Year* Long-Term** Average Flow

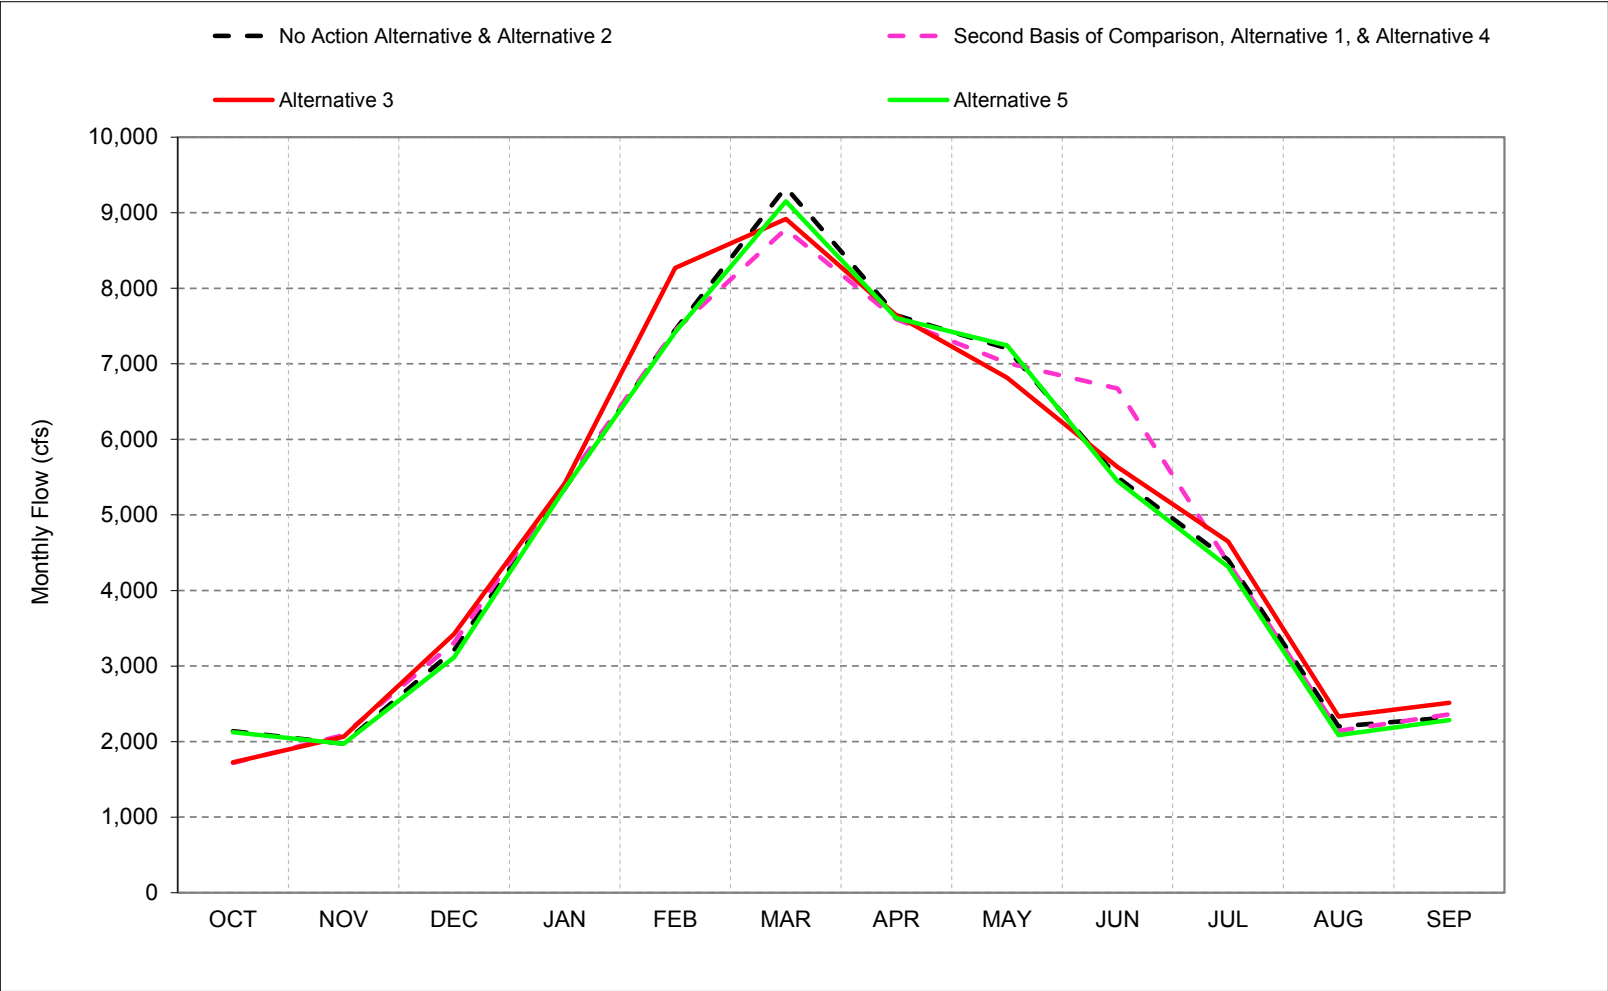


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-39-3. San Joaquin River at Vernalis - Joaquin River d/s of Merced Confluence, Above Normal Year* Long-Term** Average Flow

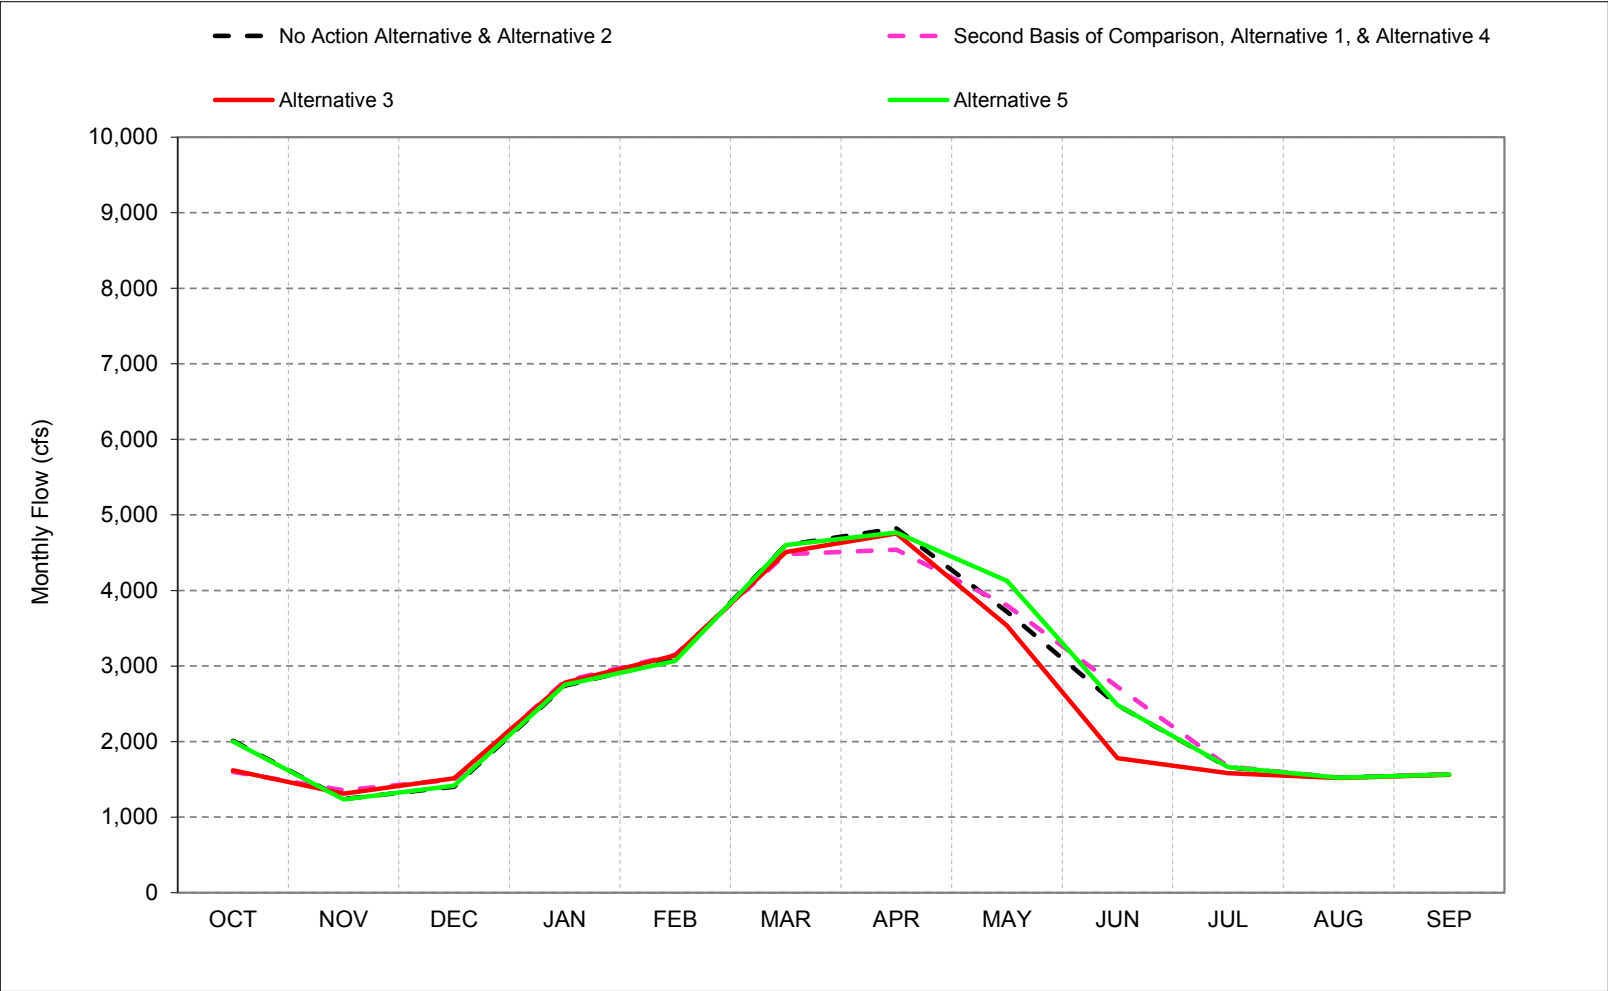


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-39-4. San Joaquin River at Vernalis - Joaquin River d/s of Merced Confluence, Below Normal Year* Long-Term** Average Flow

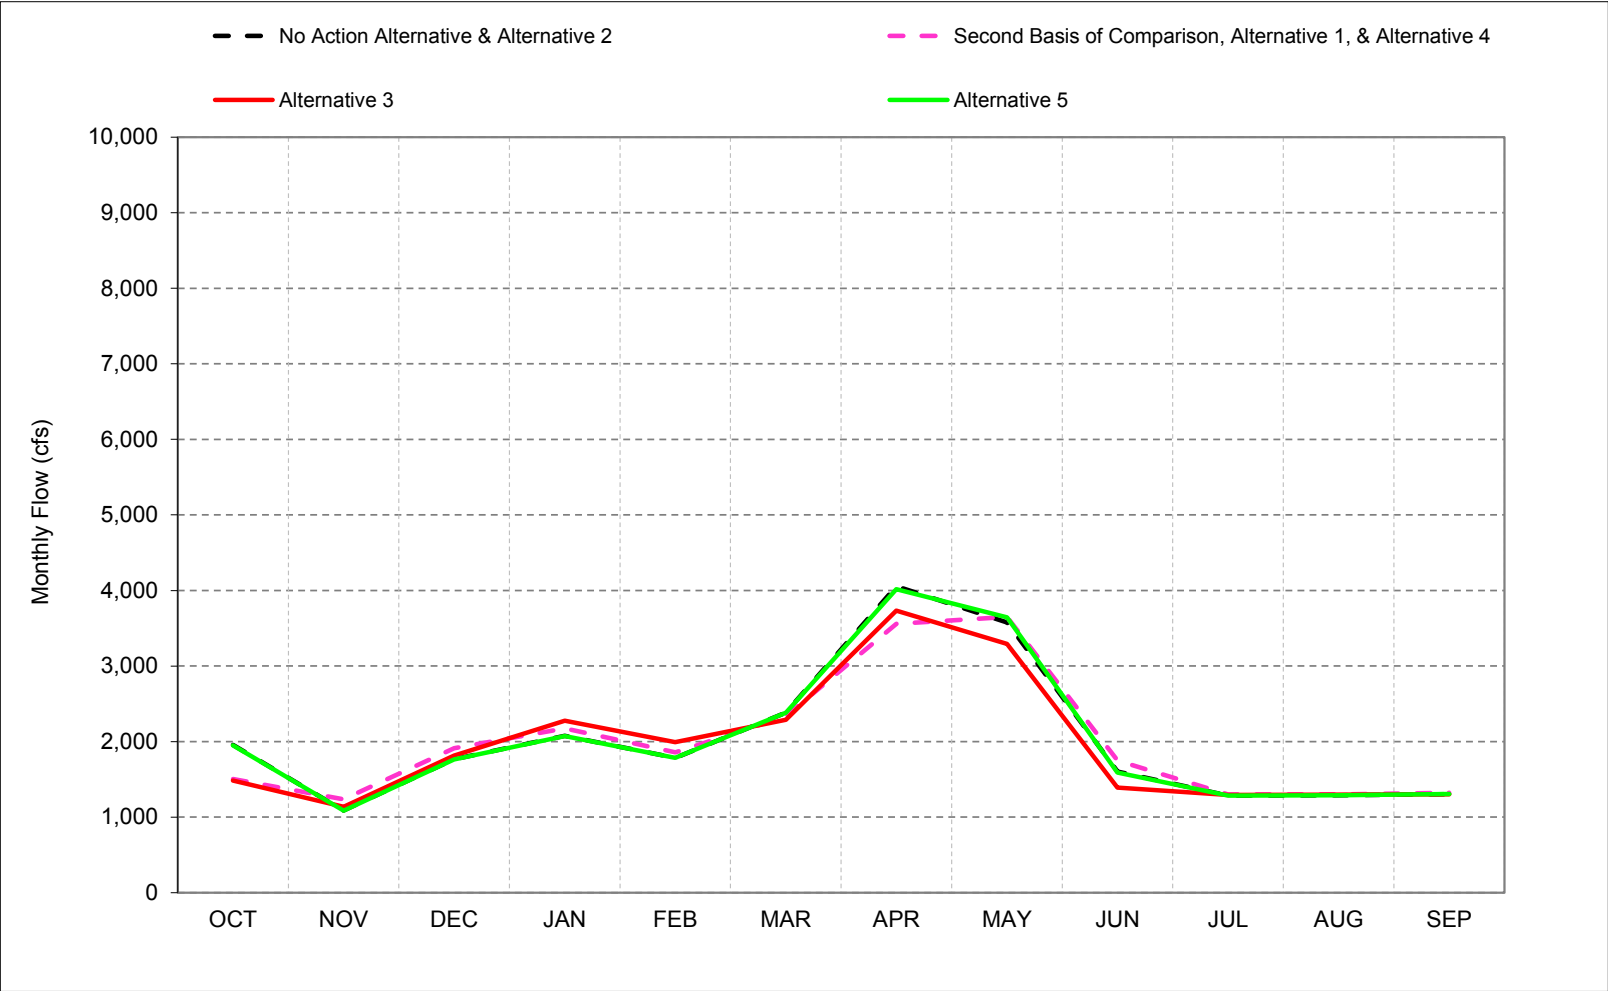


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-39-5. San Joaquin River at Vernalis - Joaquin River d/s of Merced Confluence, Dry Year* Long-Term** Average Flow

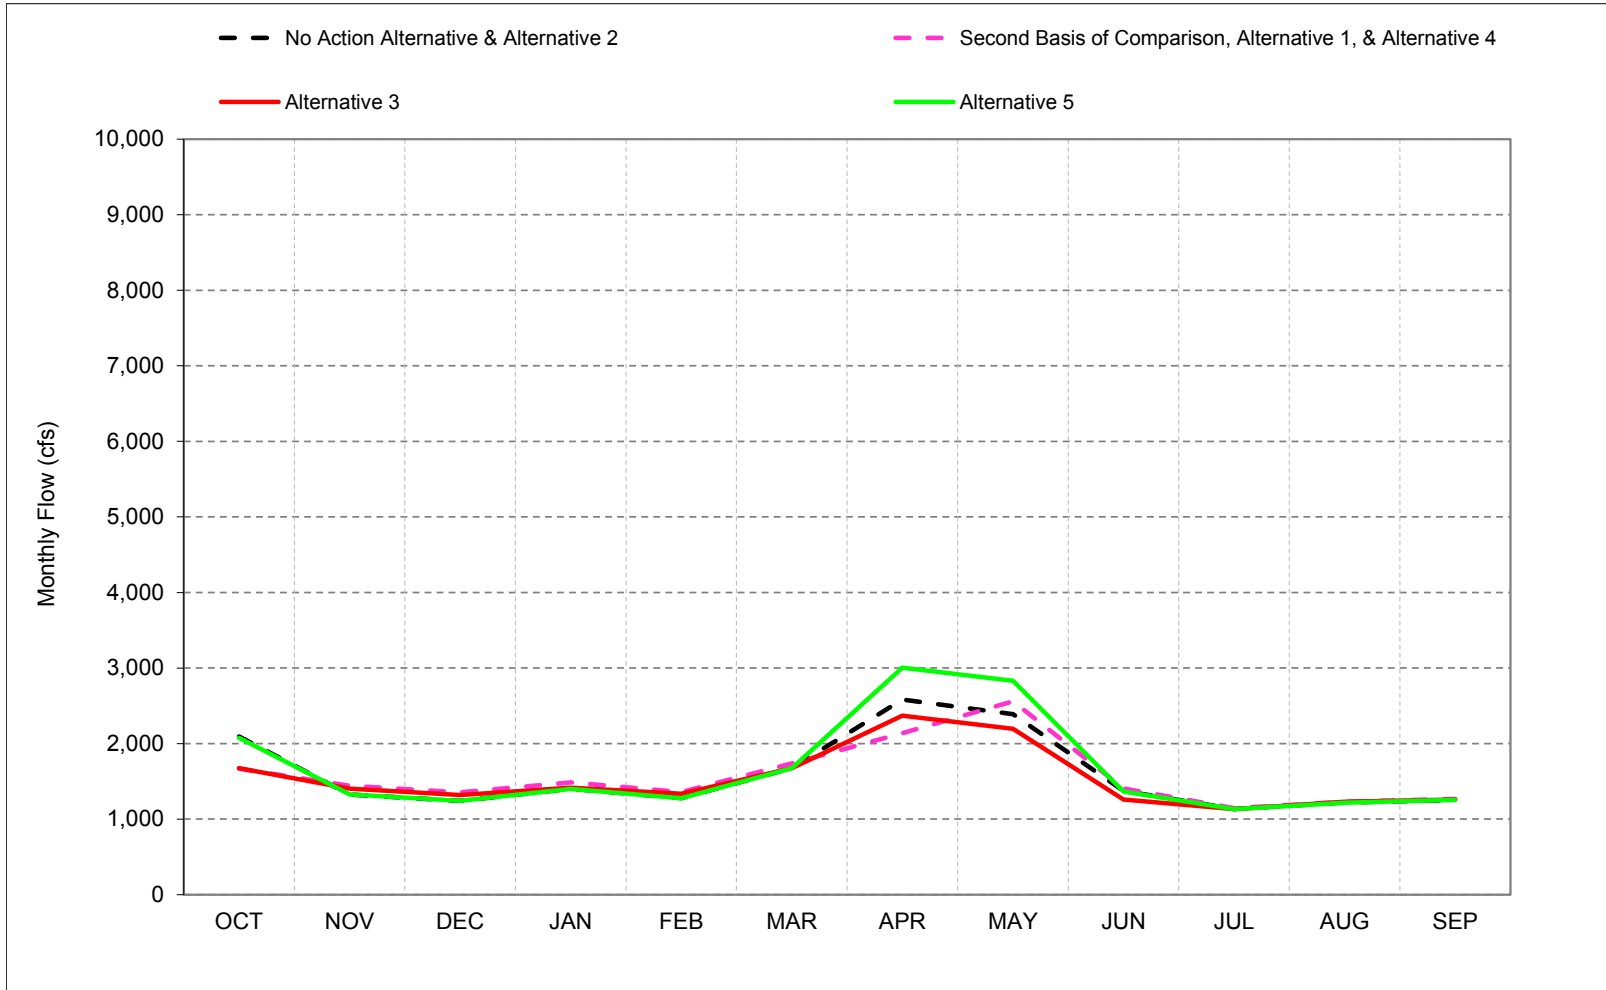


*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-39-6. San Joaquin River at Vernalis - Joaquin River d/s of Merced Confluence, Critical Year* Long-Term** Average Flow

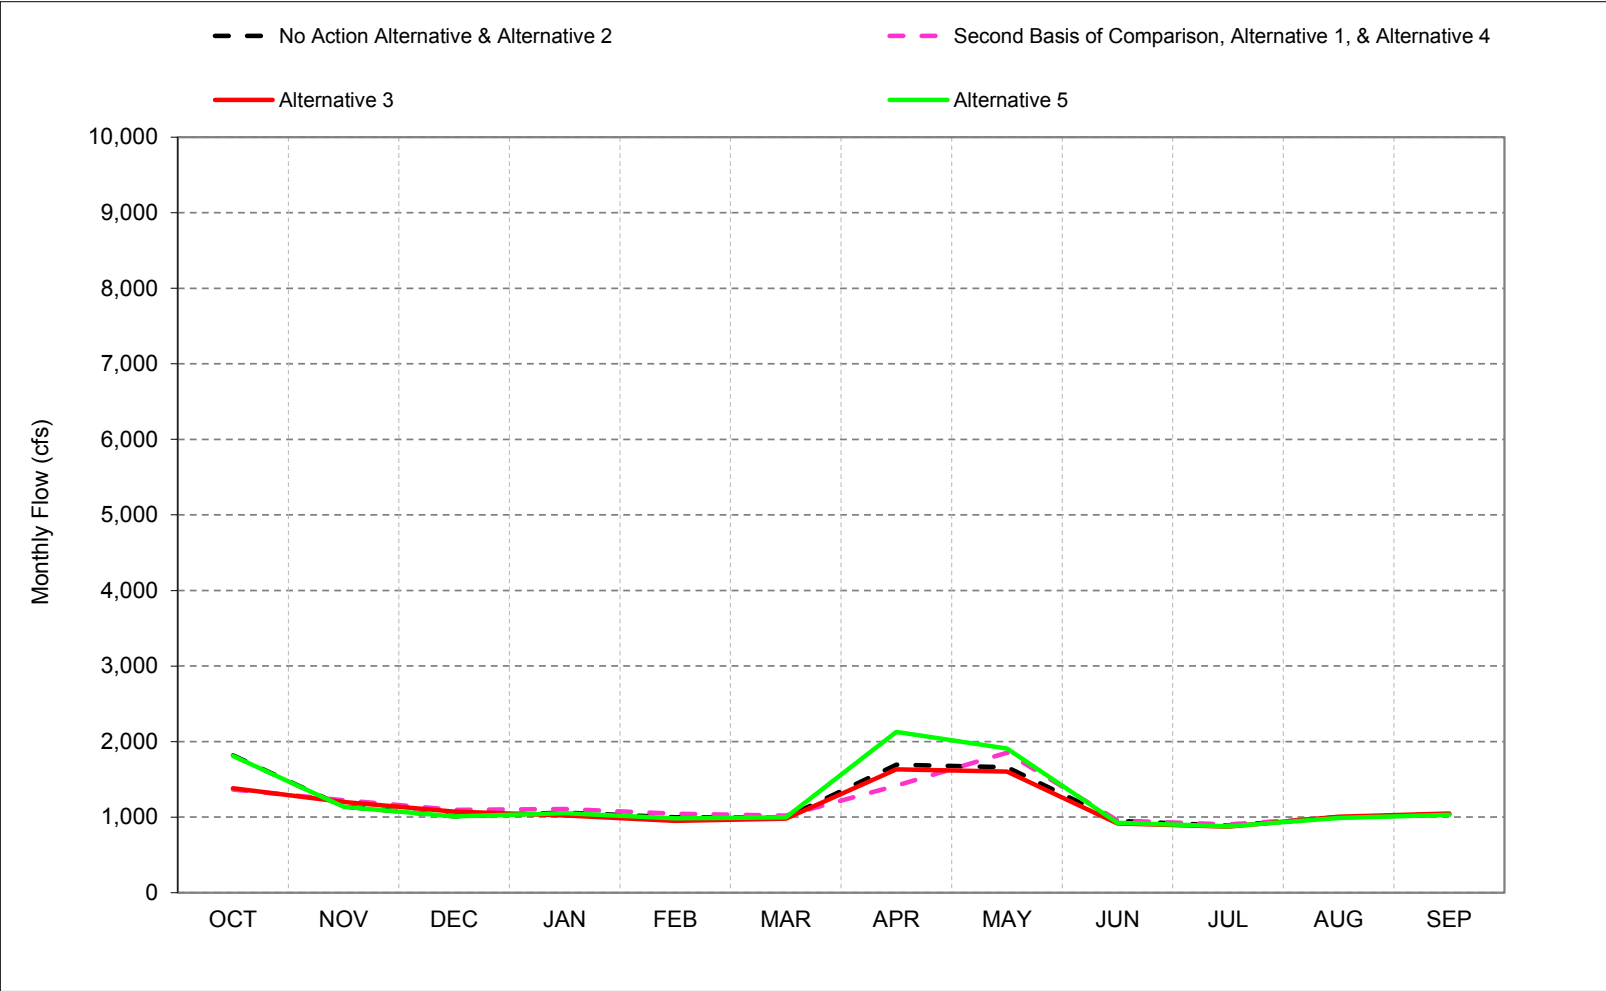

*As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

**Based on the 82-year simulation period.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-39-1. San Joaquin River at Vernalis - San Joaquin River d/s of Merced Confluence, Monthly Flow

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,505	1,686	2,261	4,481	8,588	9,439	7,674	7,184	5,515	4,577	1,821	1,918
20%	2,335	1,468	1,469	2,369	4,963	6,708	6,148	4,646	3,168	2,020	1,670	1,665
30%	2,208	1,301	1,329	1,606	2,516	5,262	5,007	4,152	2,696	1,654	1,571	1,591
40%	2,111	1,199	1,200	1,485	1,609	3,567	4,388	3,639	2,299	1,537	1,466	1,473
50%	1,994	1,129	1,125	1,387	1,375	2,036	3,598	3,113	1,799	1,305	1,334	1,382
60%	1,822	1,079	1,105	1,255	1,259	1,609	2,904	2,543	1,390	1,184	1,243	1,284
70%	1,671	1,000	1,033	1,108	1,134	1,199	2,245	2,213	1,163	1,112	1,192	1,219
80%	1,581	932	971	1,018	1,022	1,076	1,832	1,772	1,095	990	1,088	1,146
90%	1,337	843	854	888	895	909	1,496	1,509	904	860	996	1,019
Long Term												
Full Simulation Period ^b	1,997	1,381	1,727	2,616	3,124	4,051	4,206	3,750	2,508	1,970	1,468	1,523
Water Year Types^c												
Wet (23%)	2,138	1,972	3,211	5,350	7,453	9,336	7,641	7,206	5,495	4,409	2,200	2,321
Above Normal (24%)	2,012	1,239	1,402	2,737	3,085	4,602	4,823	3,720	2,482	1,662	1,522	1,564
Below Normal (10%)	1,957	1,088	1,765	2,074	1,785	2,383	4,056	3,577	1,603	1,286	1,289	1,305
Dry (16%)	2,095	1,326	1,241	1,402	1,279	1,676	2,582	2,389	1,374	1,134	1,218	1,254
Critical (27%)	1,817	1,139	1,014	1,058	999	995	1,692	1,659	951	886	999	1,036

Alternative 1

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,056	1,892	2,379	4,517	8,588	8,333	7,534	7,093	6,724	4,063	1,810	2,005
20%	1,882	1,616	1,613	2,452	5,143	6,125	5,907	4,546	3,985	2,031	1,668	1,681
30%	1,754	1,411	1,461	1,695	2,701	4,985	4,748	4,121	2,812	1,658	1,570	1,591
40%	1,648	1,330	1,340	1,625	1,750	3,378	4,029	3,788	2,430	1,546	1,470	1,494
50%	1,511	1,256	1,231	1,483	1,481	2,117	3,199	3,223	1,861	1,317	1,341	1,397
60%	1,343	1,148	1,167	1,302	1,326	1,662	2,392	2,757	1,394	1,198	1,252	1,289
70%	1,248	1,078	1,139	1,162	1,201	1,259	1,796	2,398	1,173	1,115	1,203	1,227
80%	1,127	981	1,025	1,055	1,078	1,095	1,552	1,965	1,102	1,001	1,092	1,147
90%	921	885	885	927	920	935	1,311	1,726	907	869	980	1,023
Long Term												
Full Simulation Period ^b	1,565	1,491	1,828	2,682	3,172	3,904	3,933	3,811	2,860	1,972	1,458	1,537
Water Year Types^c												
Wet (23%)	1,717	2,086	3,310	5,411	7,448	8,783	7,592	7,012	6,673	4,374	2,142	2,360
Above Normal (24%)	1,600	1,356	1,496	2,801	3,151	4,481	4,540	3,803	2,725	1,670	1,524	1,571
Below Normal (10%)	1,505	1,236	1,913	2,176	1,858	2,335	3,560	3,650	1,750	1,302	1,299	1,323
Dry (16%)	1,667	1,442	1,356	1,486	1,358	1,739	2,137	2,559	1,406	1,145	1,232	1,267
Critical (27%)	1,365	1,222	1,097	1,107	1,047	1,018	1,416	1,852	953	903	998	1,034

Alternative 1 minus No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-448	207	118	36	0	-1,106	-141	-91	1,209	-514	-12	87
20%	-453	148	144	83	180	-583	-240	-100	817	12	-2	16
30%	-454	110	132	88	184	-277	-259	-31	116	4	-2	-1
40%	-464	131	140	139	141	-189	-359	149	131	10	4	20
50%	-483	127	106	96	106	81	-399	110	62	13	7	15
60%	-478	70	62	47	67	53	-512	214	4	14	9	5
70%	-422	78	106	54	68	61	-449	185	10	3	10	8
80%	-454	49	55	37	56	20	-280	193	7	11	4	1
90%	-416	42	32	39	25	26	-186	217	4	8	-16	4
Long Term												
Full Simulation Period ^b	-431	110	101	66	47	-146	-273	61	352	2	-10	14
Water Year Types^c												
Wet (23%)	-420	114	99	61	-5	-554	-49	-193	1,177	-35	-57	39
Above Normal (24%)	-413	116	94	63	66	-121	-283	83	243	9	1	7
Below Normal (10%)	-452	148	148	102	72	-49	-496	72	147	16	10	18
Dry (16%)	-428	115	115	85	79	63	-446	170	32	11	13	13
Critical (27%)	-452	83	83	49	48	23	-276	193	1	17	-1	-2

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-39-2. San Joaquin River at Vernalis - San Joaquin River d/s of Merced Confluence, Monthly Flow

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,505	1,686	2,261	4,481	8,588	9,439	7,674	7,184	5,515	4,577	1,821	1,918
20%	2,335	1,468	1,469	2,369	4,963	6,708	6,148	4,646	3,168	2,020	1,670	1,665
30%	2,208	1,301	1,329	1,606	2,516	5,262	5,007	4,152	2,696	1,654	1,571	1,591
40%	2,111	1,199	1,200	1,485	1,609	3,567	4,388	3,639	2,299	1,537	1,466	1,473
50%	1,994	1,129	1,125	1,387	1,375	2,036	3,598	3,113	1,799	1,305	1,334	1,382
60%	1,822	1,079	1,105	1,255	1,259	1,609	2,904	2,543	1,390	1,184	1,243	1,284
70%	1,671	1,000	1,033	1,108	1,134	1,199	2,245	2,213	1,163	1,112	1,192	1,219
80%	1,581	932	971	1,018	1,022	1,076	1,832	1,772	1,095	990	1,088	1,146
90%	1,337	843	854	888	895	909	1,496	1,509	904	860	996	1,019
Long Term												
Full Simulation Period ^b	1,997	1,381	1,727	2,616	3,124	4,051	4,206	3,750	2,508	1,970	1,468	1,523
Water Year Types^c												
Wet (23%)	2,138	1,972	3,211	5,350	7,453	9,336	7,641	7,206	5,495	4,409	2,200	2,321
Above Normal (24%)	2,012	1,239	1,402	2,737	3,085	4,602	4,823	3,720	2,482	1,662	1,522	1,564
Below Normal (10%)	1,957	1,088	1,765	2,074	1,785	2,383	4,056	3,577	1,603	1,286	1,289	1,305
Dry (16%)	2,095	1,326	1,241	1,402	1,279	1,676	2,582	2,389	1,374	1,134	1,218	1,254
Critical (27%)	1,817	1,139	1,014	1,058	999	995	1,692	1,659	951	886	999	1,036

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,042	1,844	2,484	5,349	8,588	8,881	7,550	6,797	5,625	4,924	2,340	2,418
20%	1,863	1,547	1,542	2,459	5,856	6,228	6,133	4,336	2,364	1,873	1,653	1,667
30%	1,740	1,374	1,398	1,640	2,799	4,941	5,081	3,850	1,900	1,614	1,570	1,561
40%	1,655	1,277	1,300	1,525	1,684	3,279	4,146	3,453	1,709	1,517	1,468	1,473
50%	1,495	1,222	1,211	1,386	1,347	2,037	3,450	2,840	1,416	1,290	1,339	1,380
60%	1,374	1,127	1,159	1,224	1,186	1,632	2,578	2,458	1,192	1,177	1,248	1,286
70%	1,280	1,087	1,110	1,059	1,050	1,199	2,146	2,040	1,141	1,069	1,199	1,224
80%	1,147	995	1,030	981	901	1,076	1,815	1,831	987	954	1,083	1,147
90%	959	880	891	812	811	903	1,401	1,397	899	855	1,002	1,021
Long Term												
Full Simulation Period ^b	1,576	1,453	1,837	2,654	3,344	3,919	4,109	3,541	2,322	2,002	1,502	1,570
Water Year Types^c												
Wet (23%)	1,725	2,063	3,426	5,417	8,268	8,920	7,644	6,816	5,637	4,649	2,332	2,515
Above Normal (24%)	1,622	1,311	1,514	2,779	3,142	4,510	4,756	3,534	1,780	1,581	1,518	1,560
Below Normal (10%)	1,486	1,138	1,815	2,276	1,992	2,291	3,734	3,292	1,391	1,293	1,296	1,302
Dry (16%)	1,674	1,403	1,318	1,418	1,337	1,676	2,370	2,194	1,260	1,132	1,230	1,260
Critical (27%)	1,382	1,199	1,073	1,023	952	980	1,632	1,604	917	872	1,006	1,046

Alternative 3 minus No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-463	159	222	867	0	-558	-124	-387	110	347	519	500
20%	-472	79	73	90	892	-480	-15	-310	-804	-147	-17	2
30%	-468	73	69	34	283	-321	74	-302	-797	-40	-1	-30
40%	-456	79	100	39	75	-288	-242	-186	-590	-20	3	0
50%	-499	94	86	-2	-27	1	-148	-273	-383	-15	5	-1
60%	-448	48	54	-31	-73	23	-327	-85	-198	-7	5	1
70%	-390	86	77	-49	-83	0	-100	-173	-22	-43	7	5
80%	-434	63	60	-37	-121	0	-17	59	-108	-37	-5	0
90%	-378	38	37	-75	-84	-6	-95	-112	-5	-5	6	2
Long Term												
Full Simulation Period ^b	-420	71	110	39	219	-132	-97	-209	-186	32	34	47
Water Year Types^c												
Wet (23%)	-412	91	215	67	815	-417	3	-390	141	240	132	194
Above Normal (24%)	-390	72	112	42	57	-93	-67	-186	-702	-81	-4	-5
Below Normal (10%)	-471	50	50	201	206	-92	-322	-285	-212	7	6	-3
Dry (16%)	-421	77	77	17	58	0	-212	-195	-113	-3	12	6
Critical (27%)	-435	59	59	-35	-47	-15	-61	-55	-34	-14	7	9

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-39-3. San Joaquin River at Vernalis - San Joaquin River d/s of Merced Confluence, Monthly Flow

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,505	1,686	2,261	4,481	8,588	9,439	7,674	7,184	5,515	4,577	1,821	1,918
20%	2,335	1,468	1,469	2,369	4,963	6,708	6,148	4,646	3,168	2,020	1,670	1,665
30%	2,208	1,301	1,329	1,606	2,516	5,262	5,007	4,152	2,696	1,654	1,571	1,591
40%	2,111	1,199	1,200	1,485	1,609	3,567	4,388	3,639	2,299	1,537	1,466	1,473
50%	1,994	1,129	1,125	1,387	1,375	2,036	3,598	3,113	1,799	1,305	1,334	1,382
60%	1,822	1,079	1,105	1,255	1,259	1,609	2,904	2,543	1,390	1,184	1,243	1,284
70%	1,671	1,000	1,033	1,108	1,134	1,199	2,245	2,213	1,163	1,112	1,192	1,219
80%	1,581	932	971	1,018	1,022	1,076	1,832	1,772	1,095	990	1,088	1,146
90%	1,337	843	854	888	895	909	1,496	1,509	904	860	996	1,019
Long Term												
Full Simulation Period ^b	1,997	1,381	1,727	2,616	3,124	4,051	4,206	3,750	2,508	1,970	1,468	1,523
Water Year Types^c												
Wet (23%)	2,138	1,972	3,211	5,350	7,453	9,336	7,641	7,206	5,495	4,409	2,200	2,321
Above Normal (24%)	2,012	1,239	1,402	2,737	3,085	4,602	4,823	3,720	2,482	1,662	1,522	1,564
Below Normal (10%)	1,957	1,088	1,765	2,074	1,785	2,383	4,056	3,577	1,603	1,286	1,289	1,305
Dry (16%)	2,095	1,326	1,241	1,402	1,279	1,676	2,582	2,389	1,374	1,134	1,218	1,254
Critical (27%)	1,817	1,139	1,014	1,058	999	995	1,692	1,659	951	886	999	1,036

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,505	1,686	2,261	4,481	8,588	9,439	7,488	7,184	5,515	4,295	1,797	1,944
20%	2,335	1,452	1,469	2,369	4,963	6,662	6,052	4,957	3,168	2,021	1,664	1,665
30%	2,201	1,301	1,323	1,606	2,517	5,262	5,002	4,380	2,697	1,654	1,572	1,591
40%	2,071	1,199	1,200	1,485	1,584	3,567	4,421	4,045	2,299	1,537	1,466	1,473
50%	1,960	1,129	1,125	1,387	1,370	2,036	3,637	3,505	1,763	1,305	1,333	1,381
60%	1,817	1,079	1,105	1,249	1,259	1,609	3,176	3,153	1,390	1,183	1,243	1,284
70%	1,671	1,000	1,033	1,108	1,134	1,199	2,549	2,322	1,151	1,090	1,192	1,219
80%	1,547	932	971	1,018	984	1,076	2,229	2,070	1,072	978	1,075	1,121
90%	1,337	843	854	888	892	909	2,109	1,989	902	860	996	1,019
Long Term												
Full Simulation Period ^b	1,985	1,379	1,707	2,617	3,109	4,008	4,364	4,001	2,488	1,945	1,439	1,513
Water Year Types^c												
Wet (23%)	2,123	1,972	3,114	5,350	7,420	9,152	7,606	7,244	5,448	4,312	2,084	2,283
Above Normal (24%)	2,003	1,234	1,418	2,751	3,068	4,602	4,768	4,127	2,482	1,662	1,522	1,564
Below Normal (10%)	1,949	1,088	1,765	2,073	1,785	2,383	4,018	3,643	1,589	1,286	1,289	1,305
Dry (16%)	2,078	1,326	1,241	1,400	1,277	1,676	3,006	2,829	1,365	1,134	1,218	1,253
Critical (27%)	1,809	1,135	1,009	1,052	986	995	2,126	1,907	927	877	991	1,029

Alternative 5 minus No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	-1	0	0	-186	0	0	-282	-25	26
20%	0	-16	0	0	0	-46	-96	311	0	1	-7	0
30%	-8	0	-7	0	0	0	-5	228	0	0	0	0
40%	-41	0	0	0	-25	0	33	406	0	0	0	0
50%	-34	0	0	0	-5	0	39	393	-35	0	0	0
60%	-5	0	0	-6	0	0	272	610	0	-1	0	0
70%	0	0	0	0	0	0	304	109	-12	-21	0	0
80%	-34	0	0	0	-38	0	397	298	-23	-12	-13	-26
90%	0	0	0	0	-3	0	612	480	-2	0	0	0
Long Term												
Full Simulation Period ^b	-11	-2	-20	1	-15	-43	158	251	-20	-25	-29	-11
Water Year Types^c												
Wet (23%)	-15	0	-97	0	-33	-185	-35	38	-47	-97	-115	-38
Above Normal (24%)	-9	-5	16	13	-17	0	-55	407	0	0	0	0
Below Normal (10%)	-7	0	0	-1	-1	0	-38	66	-14	0	0	0
Dry (16%)	-17	0	0	-2	-2	0	424	440	-9	-1	0	0
Critical (27%)	-8	-5	-5	-6	-13	0	434	248	-24	-10	-9	-7

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-39-4. San Joaquin River at Vernalis - San Joaquin River d/s of Merced Confluence, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,056	1,892	2,379	4,517	8,588	8,333	7,534	7,093	6,724	4,063	1,810	2,005
20%	1,882	1,616	1,613	2,452	5,143	6,125	5,907	4,546	3,985	2,031	1,668	1,681
30%	1,754	1,411	1,461	1,695	2,701	4,985	4,748	4,121	2,812	1,658	1,570	1,591
40%	1,648	1,330	1,340	1,625	1,750	3,378	4,029	3,788	2,430	1,546	1,470	1,494
50%	1,511	1,256	1,231	1,483	1,481	2,117	3,199	3,223	1,861	1,317	1,341	1,397
60%	1,343	1,148	1,167	1,302	1,326	1,662	2,392	2,757	1,394	1,198	1,252	1,289
70%	1,248	1,078	1,139	1,162	1,201	1,259	1,796	2,398	1,173	1,115	1,203	1,227
80%	1,127	981	1,025	1,055	1,078	1,095	1,552	1,965	1,102	1,001	1,092	1,147
90%	921	885	885	927	920	935	1,311	1,726	907	869	980	1,023
Long Term												
Full Simulation Period ^b	1,565	1,491	1,828	2,682	3,172	3,904	3,933	3,811	2,860	1,972	1,458	1,537
Water Year Types^c												
Wet (23%)	1,717	2,086	3,310	5,411	7,448	8,783	7,592	7,012	6,673	4,374	2,142	2,360
Above Normal (24%)	1,600	1,356	1,496	2,801	3,151	4,481	4,540	3,803	2,725	1,670	1,524	1,571
Below Normal (10%)	1,505	1,236	1,913	2,176	1,858	2,335	3,560	3,650	1,750	1,302	1,299	1,323
Dry (16%)	1,667	1,442	1,356	1,486	1,358	1,739	2,137	2,559	1,406	1,145	1,232	1,267
Critical (27%)	1,365	1,222	1,097	1,107	1,047	1,018	1,416	1,852	953	903	998	1,034

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,505	1,686	2,261	4,481	8,588	9,439	7,674	7,184	5,515	4,577	1,821	1,918
20%	2,335	1,468	1,469	2,369	4,963	6,708	6,148	4,646	3,168	2,020	1,670	1,665
30%	2,208	1,301	1,329	1,606	2,516	5,262	5,007	4,152	2,696	1,654	1,571	1,591
40%	2,111	1,199	1,200	1,485	1,609	3,567	4,388	3,639	2,299	1,537	1,466	1,473
50%	1,994	1,129	1,125	1,387	1,375	2,036	3,598	3,113	1,799	1,305	1,334	1,382
60%	1,822	1,079	1,105	1,255	1,259	1,609	2,904	2,543	1,390	1,184	1,243	1,284
70%	1,671	1,000	1,033	1,108	1,134	1,199	2,245	2,213	1,163	1,112	1,192	1,219
80%	1,581	932	971	1,018	1,022	1,076	1,832	1,772	1,095	990	1,088	1,146
90%	1,337	843	854	888	895	909	1,496	1,509	904	860	996	1,019
Long Term												
Full Simulation Period ^b	1,997	1,381	1,727	2,616	3,124	4,051	4,206	3,750	2,508	1,970	1,468	1,523
Water Year Types^c												
Wet (23%)	2,138	1,972	3,211	5,350	7,453	9,336	7,641	7,206	5,495	4,409	2,200	2,321
Above Normal (24%)	2,012	1,239	1,402	2,737	3,085	4,602	4,823	3,720	2,482	1,662	1,522	1,564
Below Normal (10%)	1,957	1,088	1,765	2,074	1,785	2,383	4,056	3,577	1,603	1,286	1,289	1,305
Dry (16%)	2,095	1,326	1,241	1,402	1,279	1,676	2,582	2,389	1,374	1,134	1,218	1,254
Critical (27%)	1,817	1,139	1,014	1,058	999	995	1,692	1,659	951	886	999	1,036

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	448	-207	-118	-36	0	1,106	141	91	-1,209	514	12	-87
20%	453	-148	-144	-83	-180	583	240	100	-817	-12	2	-16
30%	454	-110	-132	-88	-184	277	259	31	-116	-4	2	1
40%	464	-131	-140	-139	-141	189	359	-149	-131	-10	-4	-20
50%	483	-127	-106	-96	-106	-81	399	-110	-62	-13	-7	-15
60%	478	-70	-62	-47	-67	-53	512	-214	-4	-14	-9	-5
70%	422	-78	-106	-54	-68	-61	449	-185	-10	-3	-10	-8
80%	454	-49	-55	-37	-56	-20	280	-193	-7	-11	-4	-1
90%	416	-42	-32	-39	-25	-26	186	-217	-4	-8	16	-4
Long Term												
Full Simulation Period ^b	431	-110	-101	-66	-47	146	273	-61	-352	-2	10	-14
Water Year Types^c												
Wet (23%)	420	-114	-99	-61	5	554	49	193	-1,177	35	57	-39
Above Normal (24%)	413	-116	-94	-63	-66	121	283	-83	-243	-9	-1	-7
Below Normal (10%)	452	-148	-148	-102	-72	49	496	-72	-147	-16	-10	-18
Dry (16%)	428	-115	-115	-85	-79	-63	446	-170	-32	-11	-13	-13
Critical (27%)	452	-83	-83	-49	-48	-23	276	-193	-1	-17	1	2

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-39-5. San Joaquin River at Vernalis - San Joaquin River d/s of Merced Confluence, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,056	1,892	2,379	4,517	8,588	8,333	7,534	7,093	6,724	4,063	1,810	2,005
20%	1,882	1,616	1,613	2,452	5,143	6,125	5,907	4,546	3,985	2,031	1,668	1,681
30%	1,754	1,411	1,461	1,695	2,701	4,985	4,748	4,121	2,812	1,658	1,570	1,591
40%	1,648	1,330	1,340	1,625	1,750	3,378	4,029	3,788	2,430	1,546	1,470	1,494
50%	1,511	1,256	1,231	1,483	1,481	2,117	3,199	3,223	1,861	1,317	1,341	1,397
60%	1,343	1,148	1,167	1,302	1,326	1,662	2,392	2,757	1,394	1,198	1,252	1,289
70%	1,248	1,078	1,139	1,162	1,201	1,259	1,796	2,398	1,173	1,115	1,203	1,227
80%	1,127	981	1,025	1,055	1,078	1,095	1,552	1,965	1,102	1,001	1,092	1,147
90%	921	885	885	927	920	935	1,311	1,726	907	869	980	1,023
Long Term												
Full Simulation Period ^b	1,565	1,491	1,828	2,682	3,172	3,904	3,933	3,811	2,860	1,972	1,458	1,537
Water Year Types^c												
Wet (23%)	1,717	2,086	3,310	5,411	7,448	8,783	7,592	7,012	6,673	4,374	2,142	2,360
Above Normal (24%)	1,600	1,356	1,496	2,801	3,151	4,481	4,540	3,803	2,725	1,670	1,524	1,571
Below Normal (10%)	1,505	1,236	1,913	2,176	1,858	2,335	3,560	3,650	1,750	1,302	1,299	1,323
Dry (16%)	1,667	1,442	1,356	1,486	1,358	1,739	2,137	2,559	1,406	1,145	1,232	1,267
Critical (27%)	1,365	1,222	1,097	1,107	1,047	1,018	1,416	1,852	953	903	998	1,034

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,042	1,844	2,484	5,349	8,588	8,881	7,550	6,797	5,625	4,924	2,340	2,418
20%	1,863	1,547	1,542	2,459	5,856	6,228	6,133	4,336	2,364	1,873	1,653	1,667
30%	1,740	1,374	1,398	1,640	2,799	4,941	5,081	3,850	1,900	1,614	1,570	1,561
40%	1,655	1,277	1,300	1,525	1,684	3,279	4,146	3,453	1,709	1,517	1,468	1,473
50%	1,495	1,222	1,211	1,386	1,347	2,037	3,450	2,840	1,416	1,290	1,339	1,380
60%	1,374	1,127	1,159	1,224	1,186	1,632	2,578	2,458	1,192	1,177	1,248	1,286
70%	1,280	1,087	1,110	1,059	1,050	1,199	2,146	2,040	1,141	1,069	1,199	1,224
80%	1,147	995	1,030	981	901	1,076	1,815	1,831	987	954	1,083	1,147
90%	959	880	891	812	811	903	1,401	1,397	899	855	1,002	1,021
Long Term												
Full Simulation Period ^b	1,576	1,453	1,837	2,654	3,344	3,919	4,109	3,541	2,322	2,002	1,502	1,570
Water Year Types^c												
Wet (23%)	1,725	2,063	3,426	5,417	8,268	8,920	7,644	6,816	5,637	4,649	2,332	2,515
Above Normal (24%)	1,622	1,311	1,514	2,779	3,142	4,510	4,756	3,534	1,780	1,581	1,518	1,560
Below Normal (10%)	1,486	1,138	1,815	2,276	1,992	2,291	3,734	3,292	1,391	1,293	1,296	1,302
Dry (16%)	1,674	1,403	1,318	1,418	1,337	1,676	2,370	2,194	1,260	1,132	1,230	1,260
Critical (27%)	1,382	1,199	1,073	1,023	952	980	1,632	1,604	917	872	1,006	1,046

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-14	-48	104	832	0	548	16	-296	-1,099	861	530	413
20%	-19	-69	-71	7	713	103	226	-210	-1,621	-158	-15	-14
30%	-15	-37	-63	-55	98	-44	333	-271	-913	-44	1	-30
40%	8	-53	-40	-100	-66	-99	117	-335	-722	-29	-1	-20
50%	-16	-33	-20	-98	-134	-80	251	-383	-445	-27	-2	-16
60%	31	-21	-8	-78	-140	-30	185	-298	-202	-21	-4	-4
70%	32	8	-29	-103	-151	-60	349	-357	-32	-46	-4	-3
80%	20	14	5	-74	-176	-19	263	-134	-115	-48	-10	0
90%	38	-5	5	-114	-109	-32	90	-329	-8	-14	22	-2
Long Term												
Full Simulation Period ^b	11	-38	9	-27	172	14	176	-271	-538	31	44	33
Water Year Types^c												
Wet (23%)	8	-23	116	6	820	137	52	-197	-1,036	275	189	154
Above Normal (24%)	22	-45	18	-21	-9	29	216	-270	-945	-89	-5	-11
Below Normal (10%)	-19	-98	-98	100	134	-44	173	-357	-359	-8	-3	-22
Dry (16%)	7	-38	-38	-68	-21	-62	233	-365	-146	-14	-2	-7
Critical (27%)	16	-24	-24	-84	-95	-38	215	-248	-36	-31	8	12

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table C-39-6. San Joaquin River at Vernalis - San Joaquin River d/s of Merced Confluence, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,056	1,892	2,379	4,517	8,588	8,333	7,534	7,093	6,724	4,063	1,810	2,005
20%	1,882	1,616	1,613	2,452	5,143	6,125	5,907	4,546	3,985	2,031	1,668	1,681
30%	1,754	1,411	1,461	1,695	2,701	4,985	4,748	4,121	2,812	1,658	1,570	1,591
40%	1,648	1,330	1,340	1,625	1,750	3,378	4,029	3,788	2,430	1,546	1,470	1,494
50%	1,511	1,256	1,231	1,483	1,481	2,117	3,199	3,223	1,861	1,317	1,341	1,397
60%	1,343	1,148	1,167	1,302	1,326	1,662	2,392	2,757	1,394	1,198	1,252	1,289
70%	1,248	1,078	1,139	1,162	1,201	1,259	1,796	2,398	1,173	1,115	1,203	1,227
80%	1,127	981	1,025	1,055	1,078	1,095	1,552	1,965	1,102	1,001	1,092	1,147
90%	921	885	885	927	920	935	1,311	1,726	907	869	980	1,023
Long Term												
Full Simulation Period ^b	1,565	1,491	1,828	2,682	3,172	3,904	3,933	3,811	2,860	1,972	1,458	1,537
Water Year Types^c												
Wet (23%)	1,717	2,086	3,310	5,411	7,448	8,783	7,592	7,012	6,673	4,374	2,142	2,360
Above Normal (24%)	1,600	1,356	1,496	2,801	3,151	4,481	4,540	3,803	2,725	1,670	1,524	1,571
Below Normal (10%)	1,505	1,236	1,913	2,176	1,858	2,335	3,560	3,650	1,750	1,302	1,299	1,323
Dry (16%)	1,667	1,442	1,356	1,486	1,358	1,739	2,137	2,559	1,406	1,145	1,232	1,267
Critical (27%)	1,365	1,222	1,097	1,107	1,047	1,018	1,416	1,852	953	903	998	1,034

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,505	1,686	2,261	4,481	8,588	9,439	7,488	7,184	5,515	4,295	1,797	1,944
20%	2,335	1,452	1,469	2,369	4,963	6,662	6,052	4,957	3,168	2,021	1,664	1,665
30%	2,201	1,301	1,323	1,606	2,517	5,262	5,002	4,380	2,697	1,654	1,572	1,591
40%	2,071	1,199	1,200	1,485	1,584	3,567	4,421	4,045	2,299	1,537	1,466	1,473
50%	1,960	1,129	1,125	1,387	1,370	2,036	3,637	3,505	1,763	1,305	1,333	1,381
60%	1,817	1,079	1,105	1,249	1,259	1,609	3,176	3,153	1,390	1,183	1,243	1,284
70%	1,671	1,000	1,033	1,108	1,134	1,199	2,549	2,322	1,151	1,090	1,192	1,219
80%	1,547	932	971	1,018	984	1,076	2,229	2,070	1,072	978	1,075	1,121
90%	1,337	843	854	888	892	909	2,109	1,989	902	860	996	1,019
Long Term												
Full Simulation Period ^b	1,985	1,379	1,707	2,617	3,109	4,008	4,364	4,001	2,488	1,945	1,439	1,513
Water Year Types^c												
Wet (23%)	2,123	1,972	3,114	5,350	7,420	9,152	7,606	7,244	5,448	4,312	2,084	2,283
Above Normal (24%)	2,003	1,234	1,418	2,751	3,068	4,602	4,768	4,127	2,482	1,662	1,522	1,564
Below Normal (10%)	1,949	1,088	1,765	2,073	1,785	2,383	4,018	3,643	1,589	1,286	1,289	1,305
Dry (16%)	2,078	1,326	1,241	1,400	1,277	1,676	3,006	2,829	1,365	1,134	1,218	1,253
Critical (27%)	1,809	1,135	1,009	1,052	986	995	2,126	1,907	927	877	991	1,029

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	448	-207	-118	-36	0	1,106	-45	91	-1,209	232	-13	-62
20%	453	-164	-144	-83	-180	537	145	411	-816	-11	-5	-16
30%	446	-110	-139	-88	-184	277	254	259	-116	-4	2	0
40%	423	-131	-140	-139	-166	189	392	257	-131	-10	-4	-21
50%	448	-127	-106	-96	-111	-81	438	282	-97	-12	-8	-15
60%	474	-70	-62	-53	-67	-53	784	396	-4	-15	-9	-5
70%	422	-78	-106	-54	-68	-61	753	-76	-21	-25	-11	-8
80%	420	-49	-55	-37	-93	-20	677	105	-29	-24	-17	-26
90%	416	-42	-32	-39	-28	-26	798	264	-6	-8	16	-4
Long Term												
Full Simulation Period ^b	420	-112	-121	-65	-63	104	432	189	-372	-27	-19	-25
Water Year Types^c												
Wet (23%)	406	-114	-196	-62	-28	369	14	231	-1,225	-61	-58	-77
Above Normal (24%)	403	-121	-79	-50	-83	121	228	324	-243	-9	-2	-7
Below Normal (10%)	445	-148	-148	-102	-73	49	458	-6	-161	-16	-10	-19
Dry (16%)	411	-115	-115	-86	-81	-63	869	270	-41	-12	-14	-13
Critical (27%)	443	-88	-88	-55	-61	-23	710	55	-26	-26	-8	-5

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.


1 **C.40. Steamboat Slough downstream of Sutter Slough Water**
2 **Surface Elevation**

Figure C-40-1-1. Steamboat Sl d/s of Sutter Sl, Monthly Averaged Daily Maximum Elevation, October

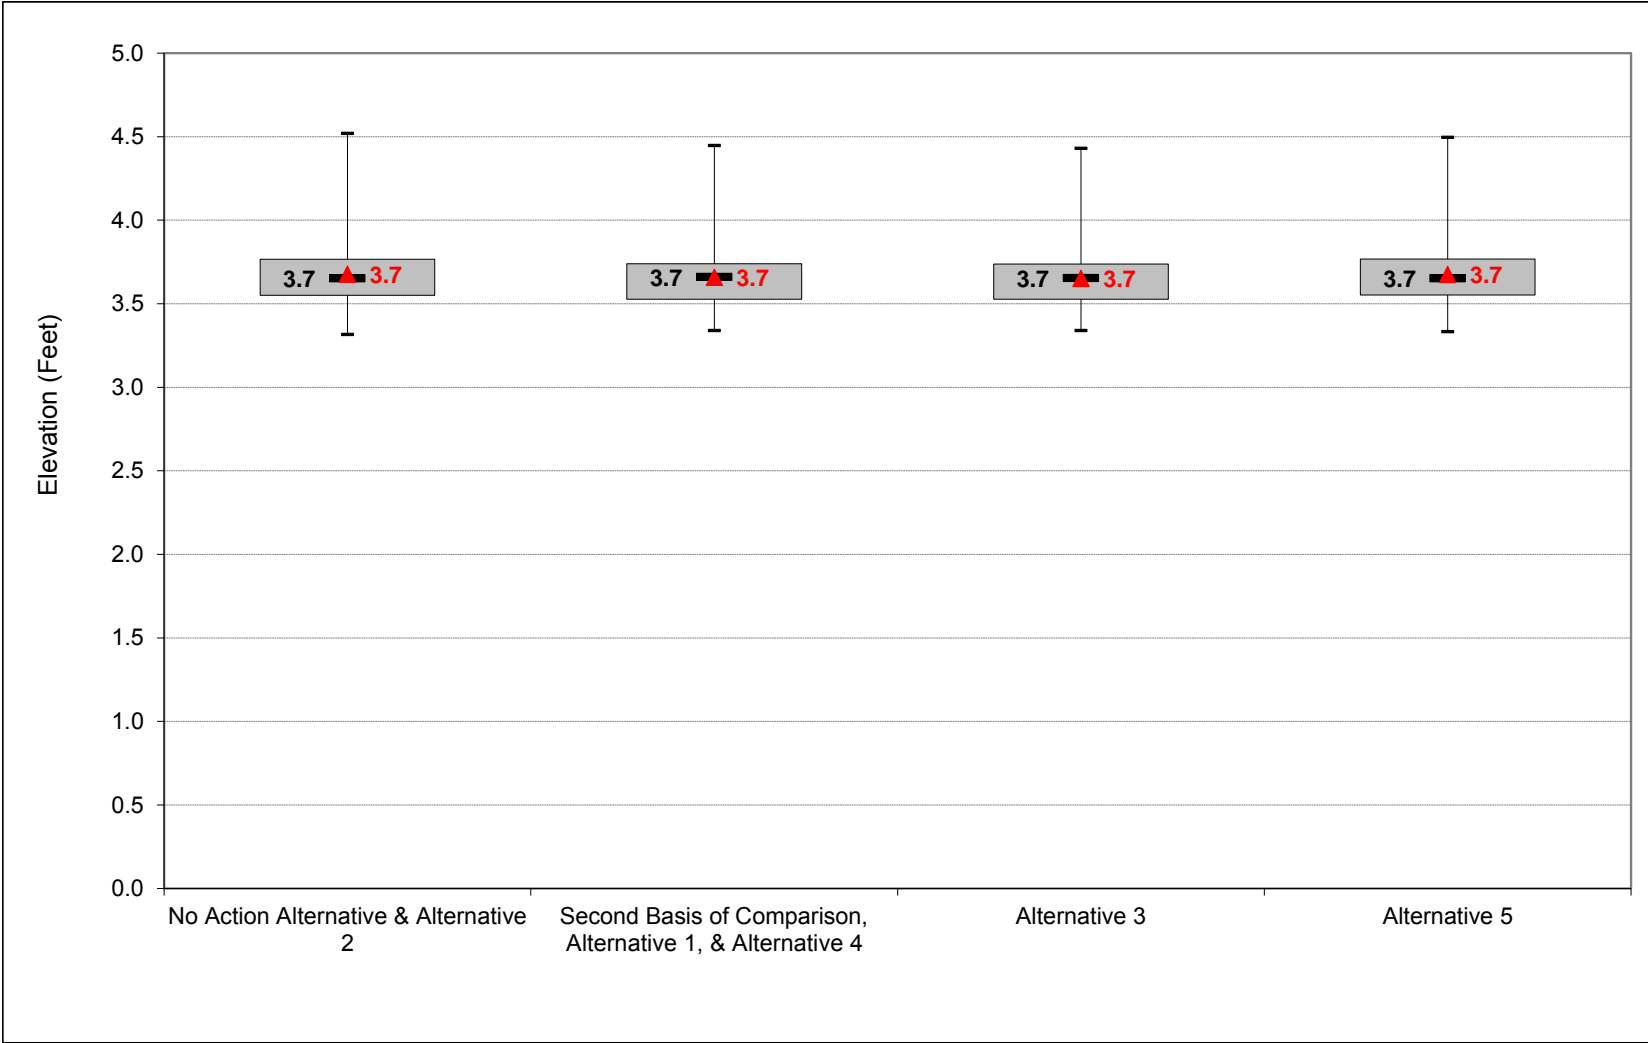


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-40-1-2. Steamboat Sl d/s of Sutter Sl, Monthly Averaged Daily Maximum Elevation, November

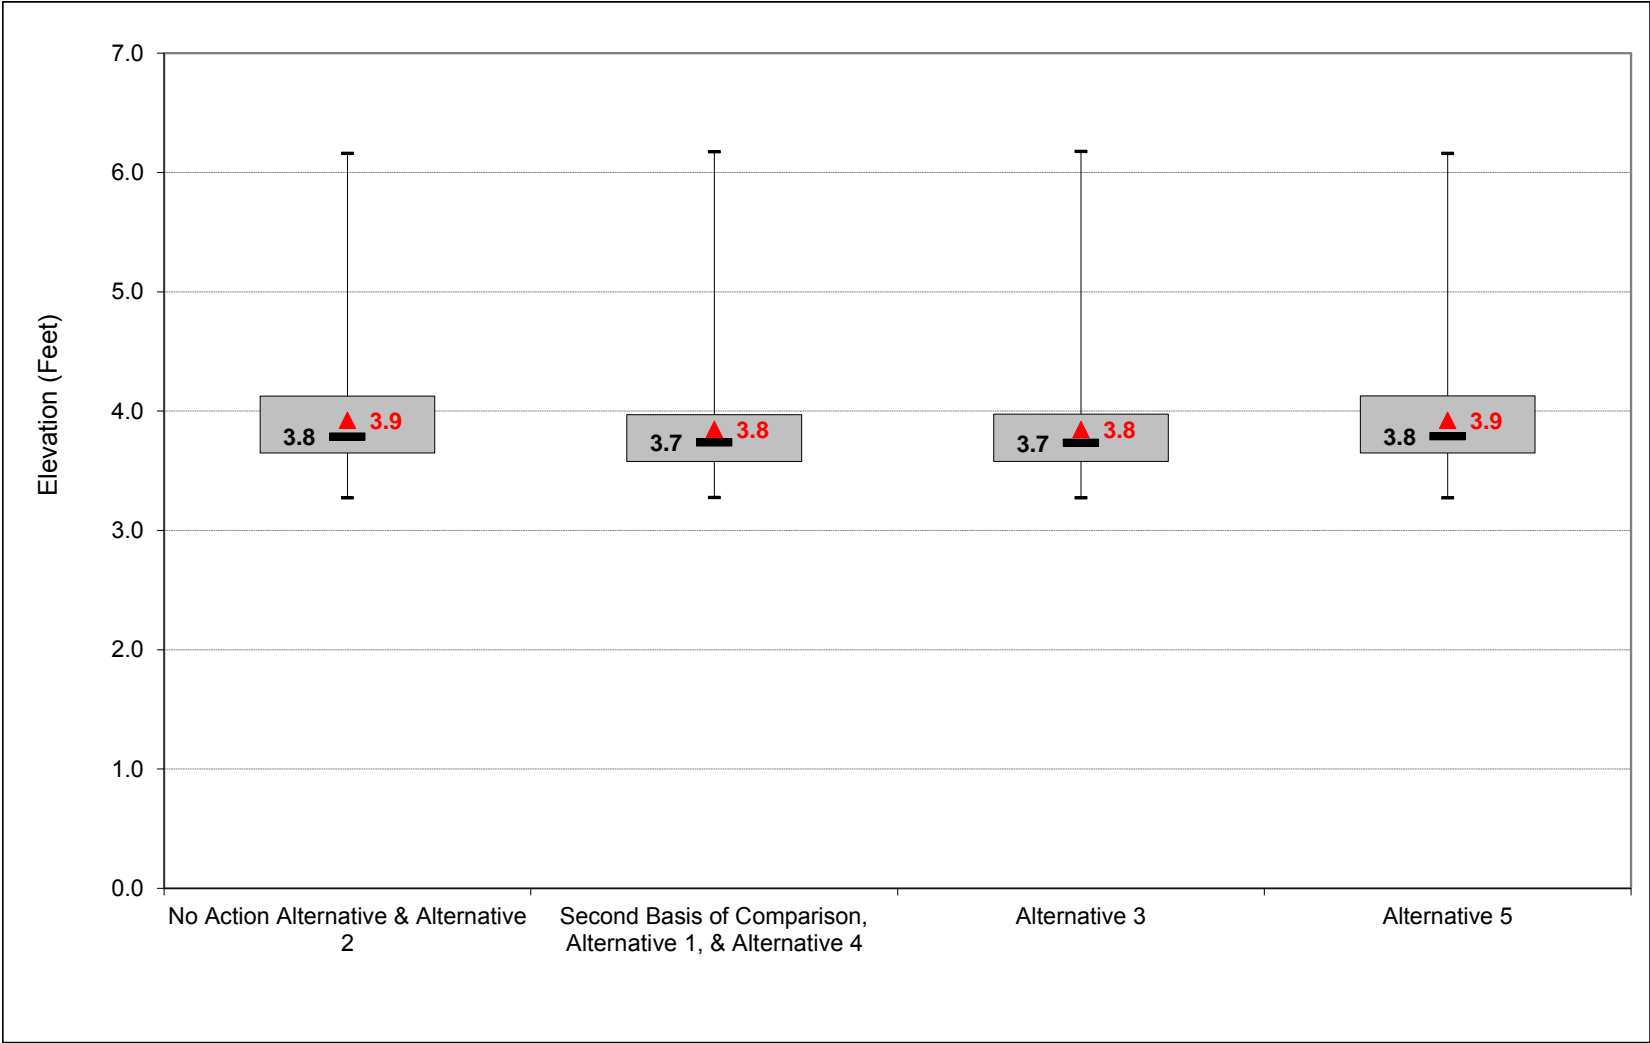


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-40-1-3. Steamboat Sl d/s of Sutter Sl, Monthly Averaged Daily Maximum Elevation, December

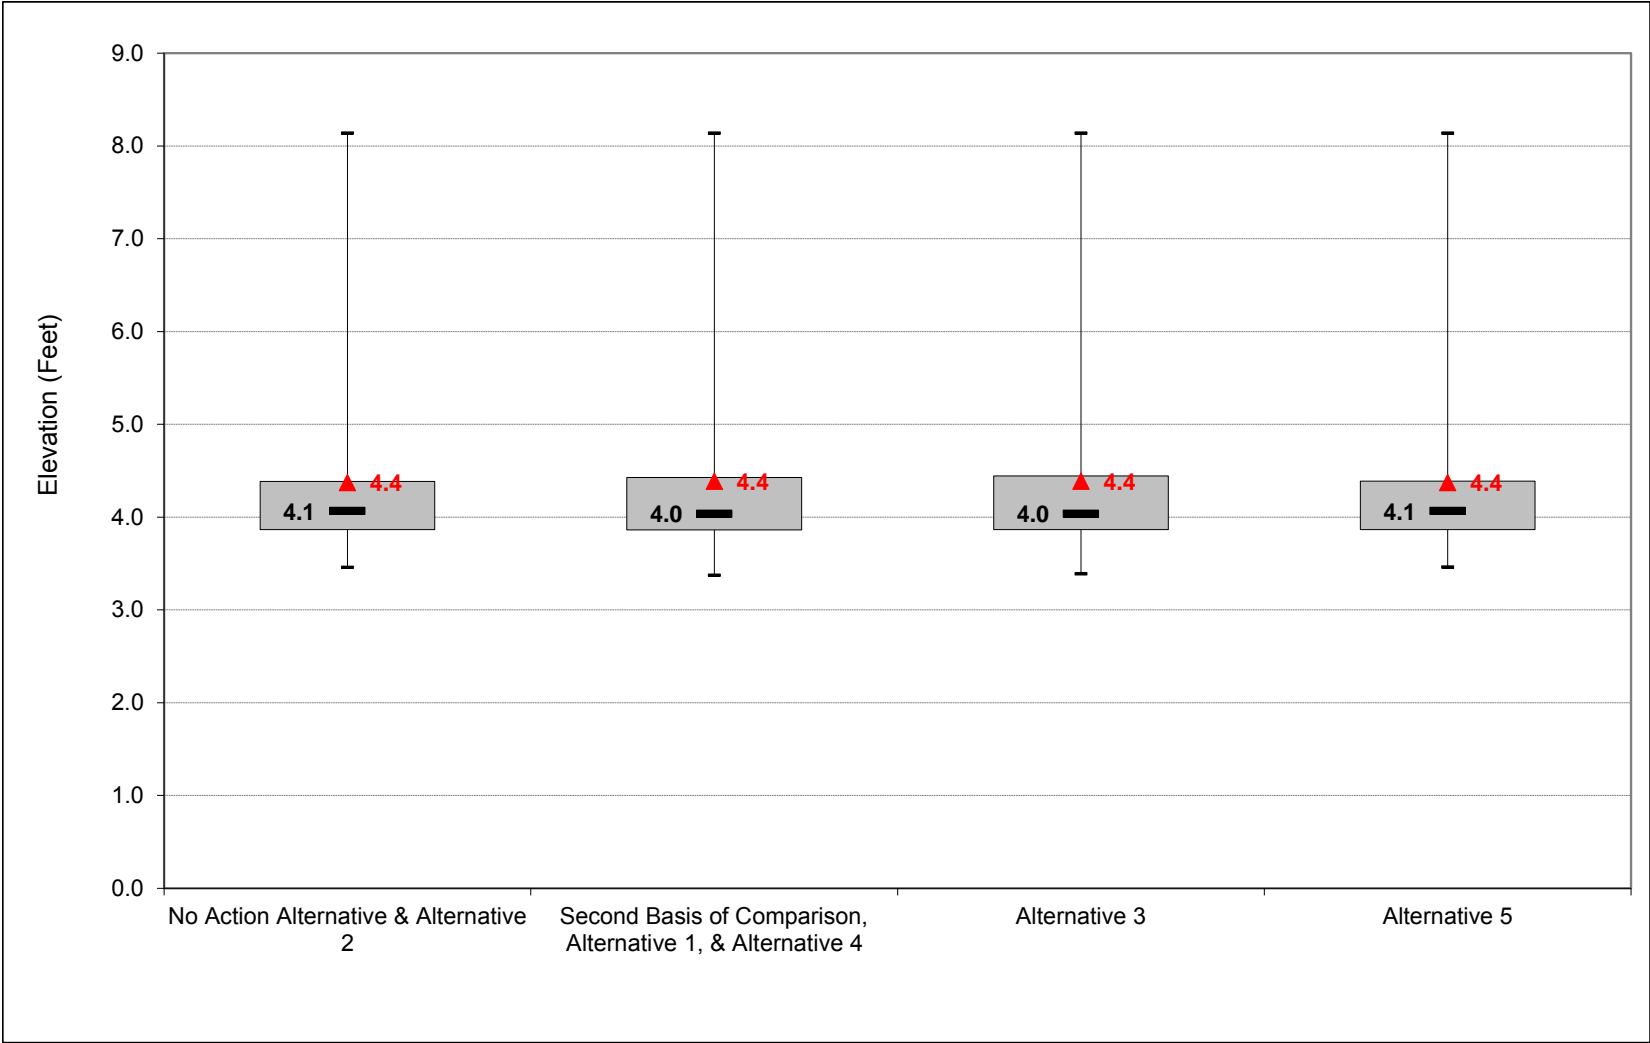


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-40-1-4. Steamboat Sl d/s of Sutter Sl, Monthly Averaged Daily Maximum Elevation, January

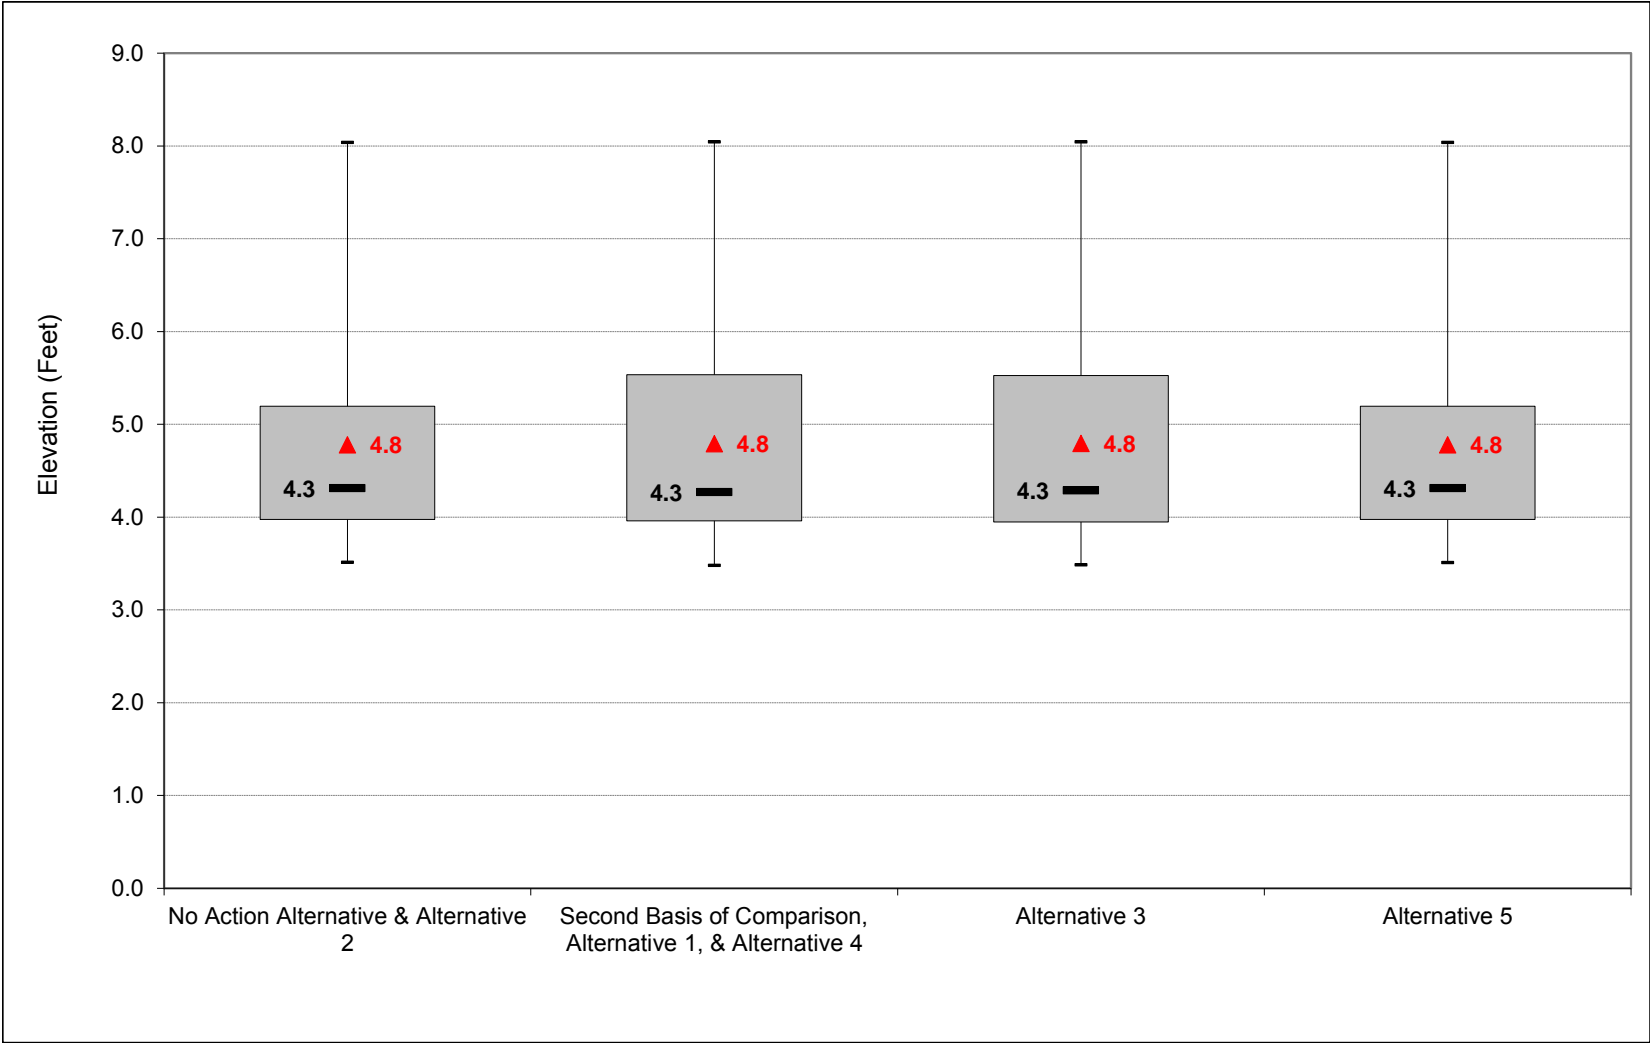


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-40-1-5. Steamboat Sl d/s of Sutter Sl, Monthly Averaged Daily Maximum Elevation, February

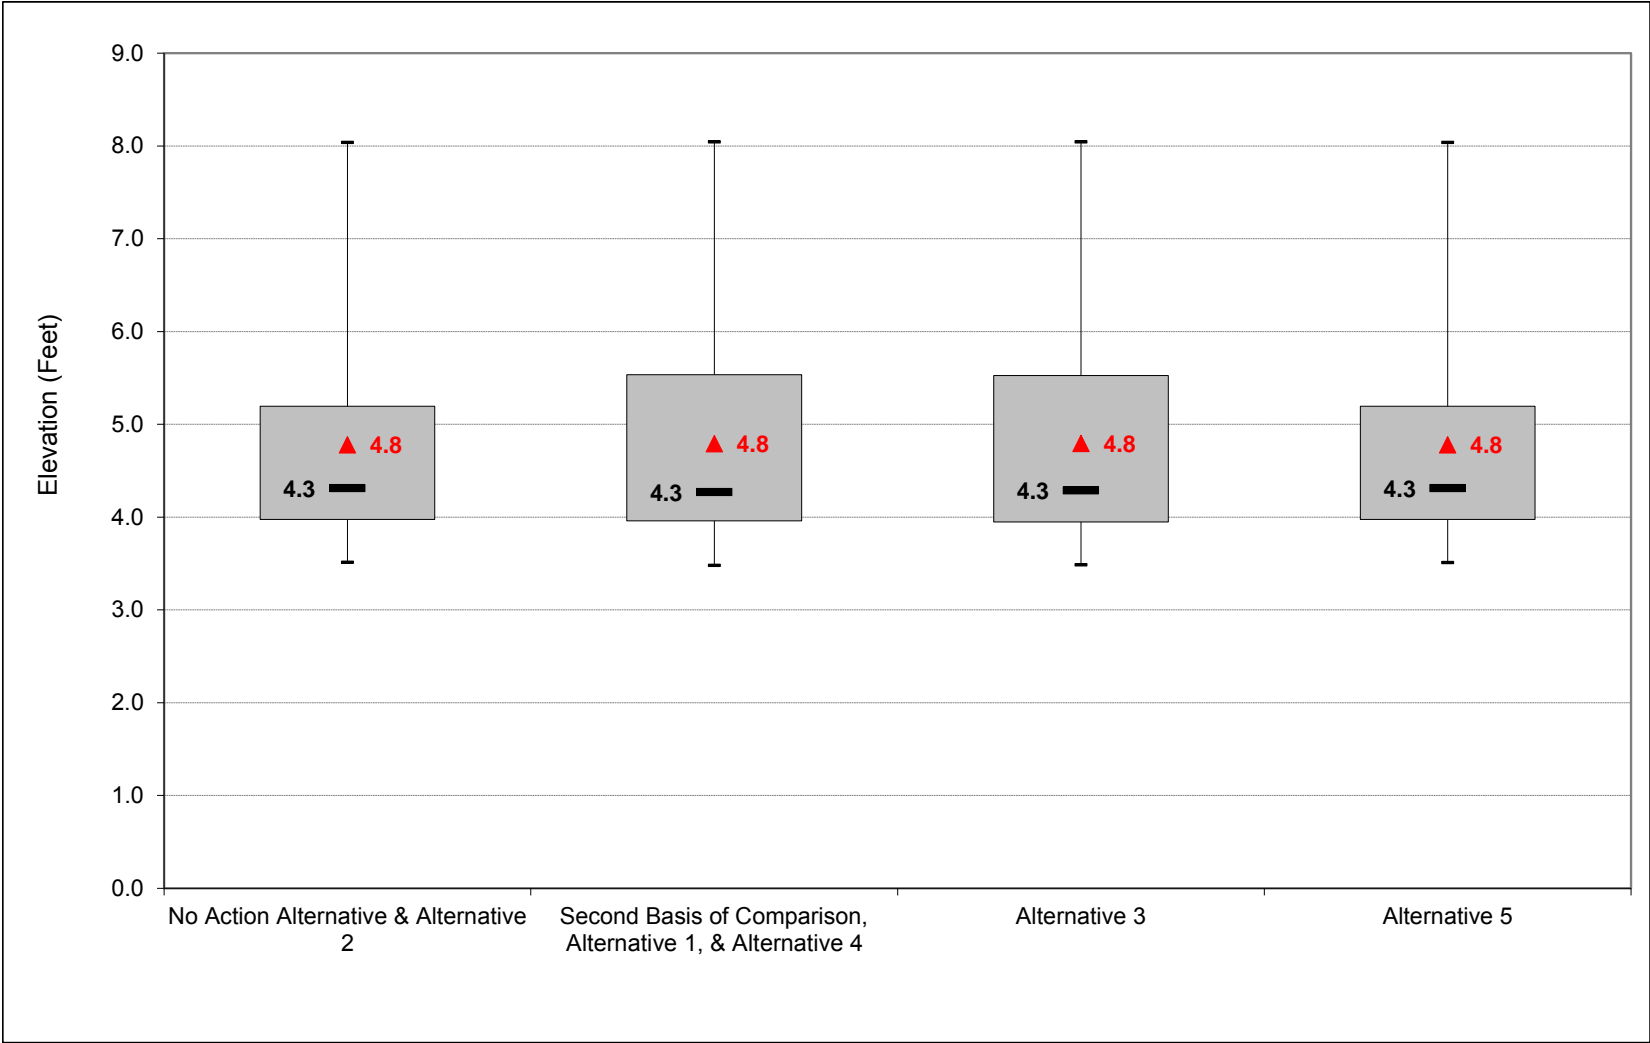


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-40-1-6. Steamboat Sl d/s of Sutter Sl, Monthly Averaged Daily Maximum Elevation, March

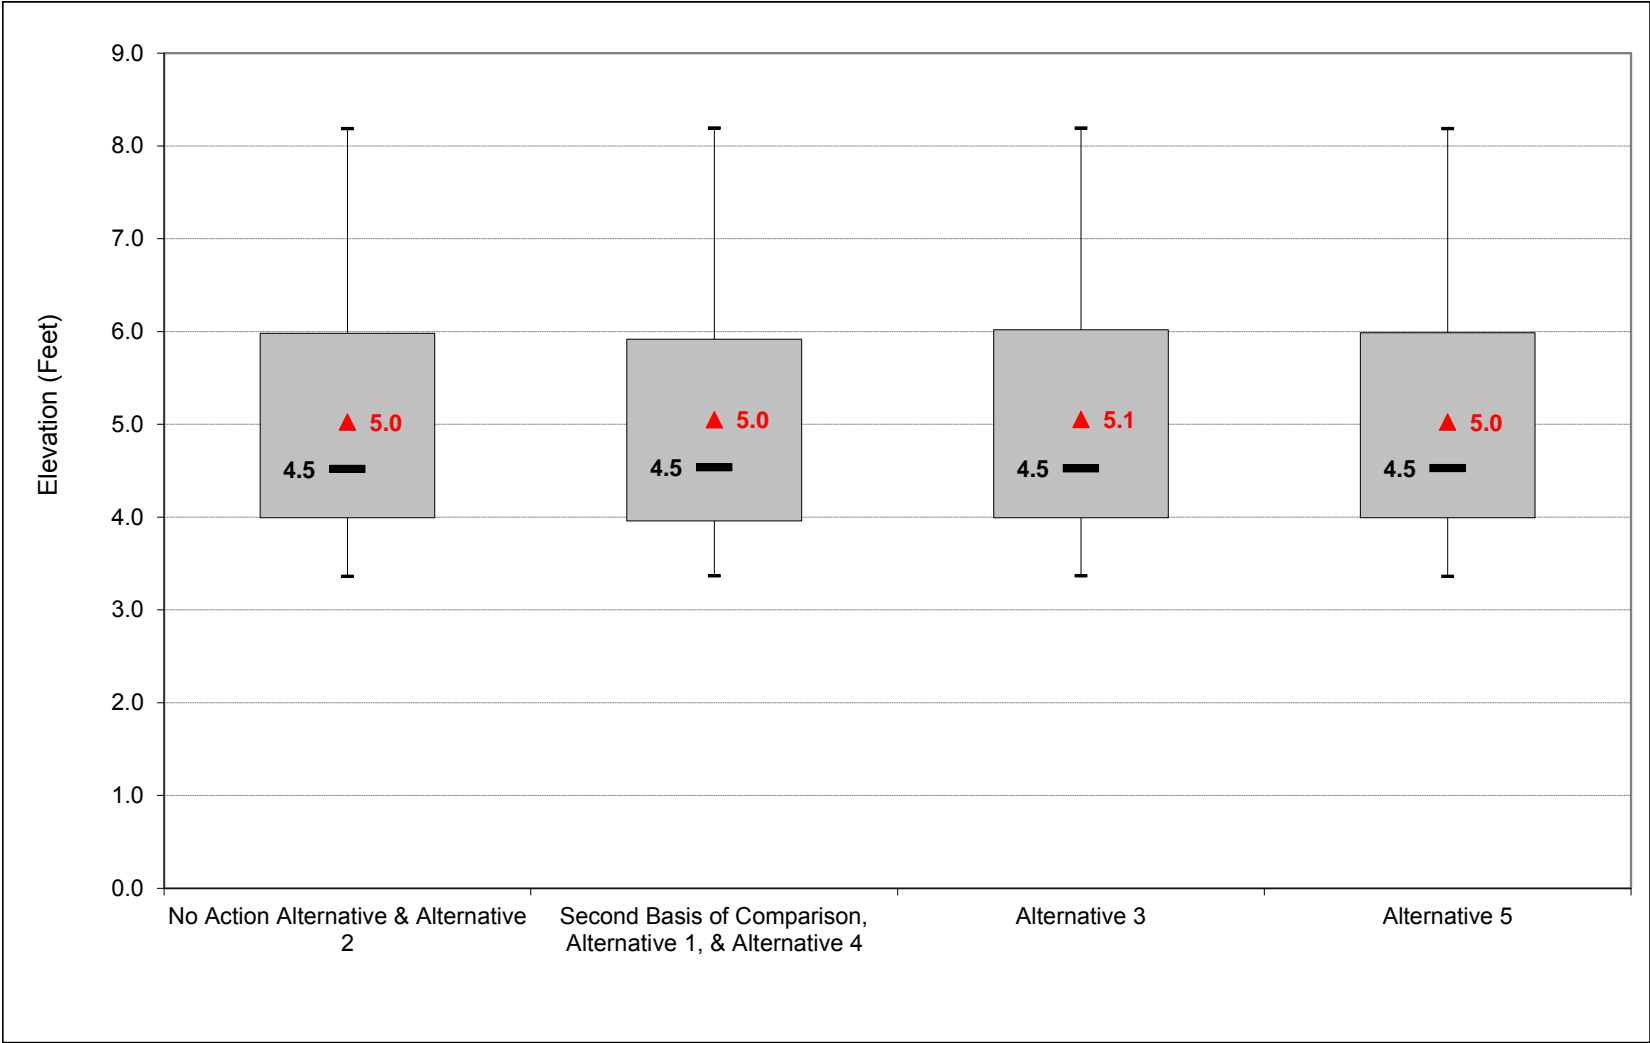


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-40-1-7. Steamboat Sl d/s of Sutter Sl, Monthly Averaged Daily Maximum Elevation, April

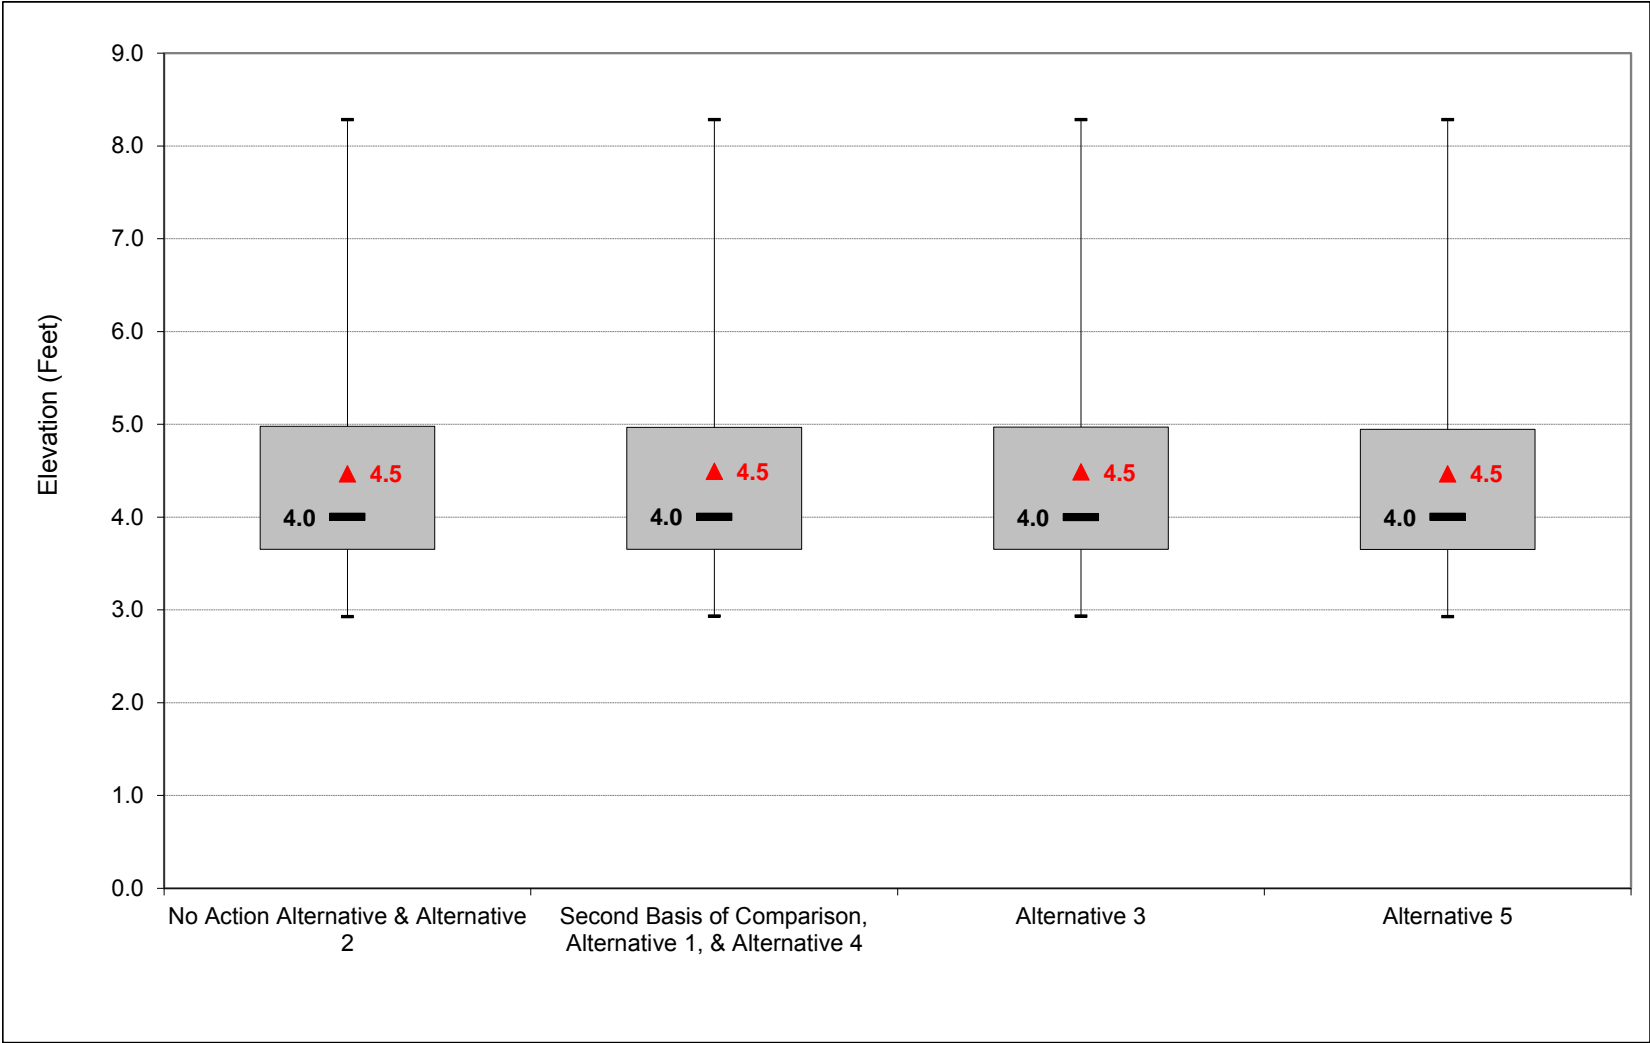


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-40-1-8. Steamboat Sl d/s of Sutter Sl, Monthly Averaged Daily Maximum Elevation, May

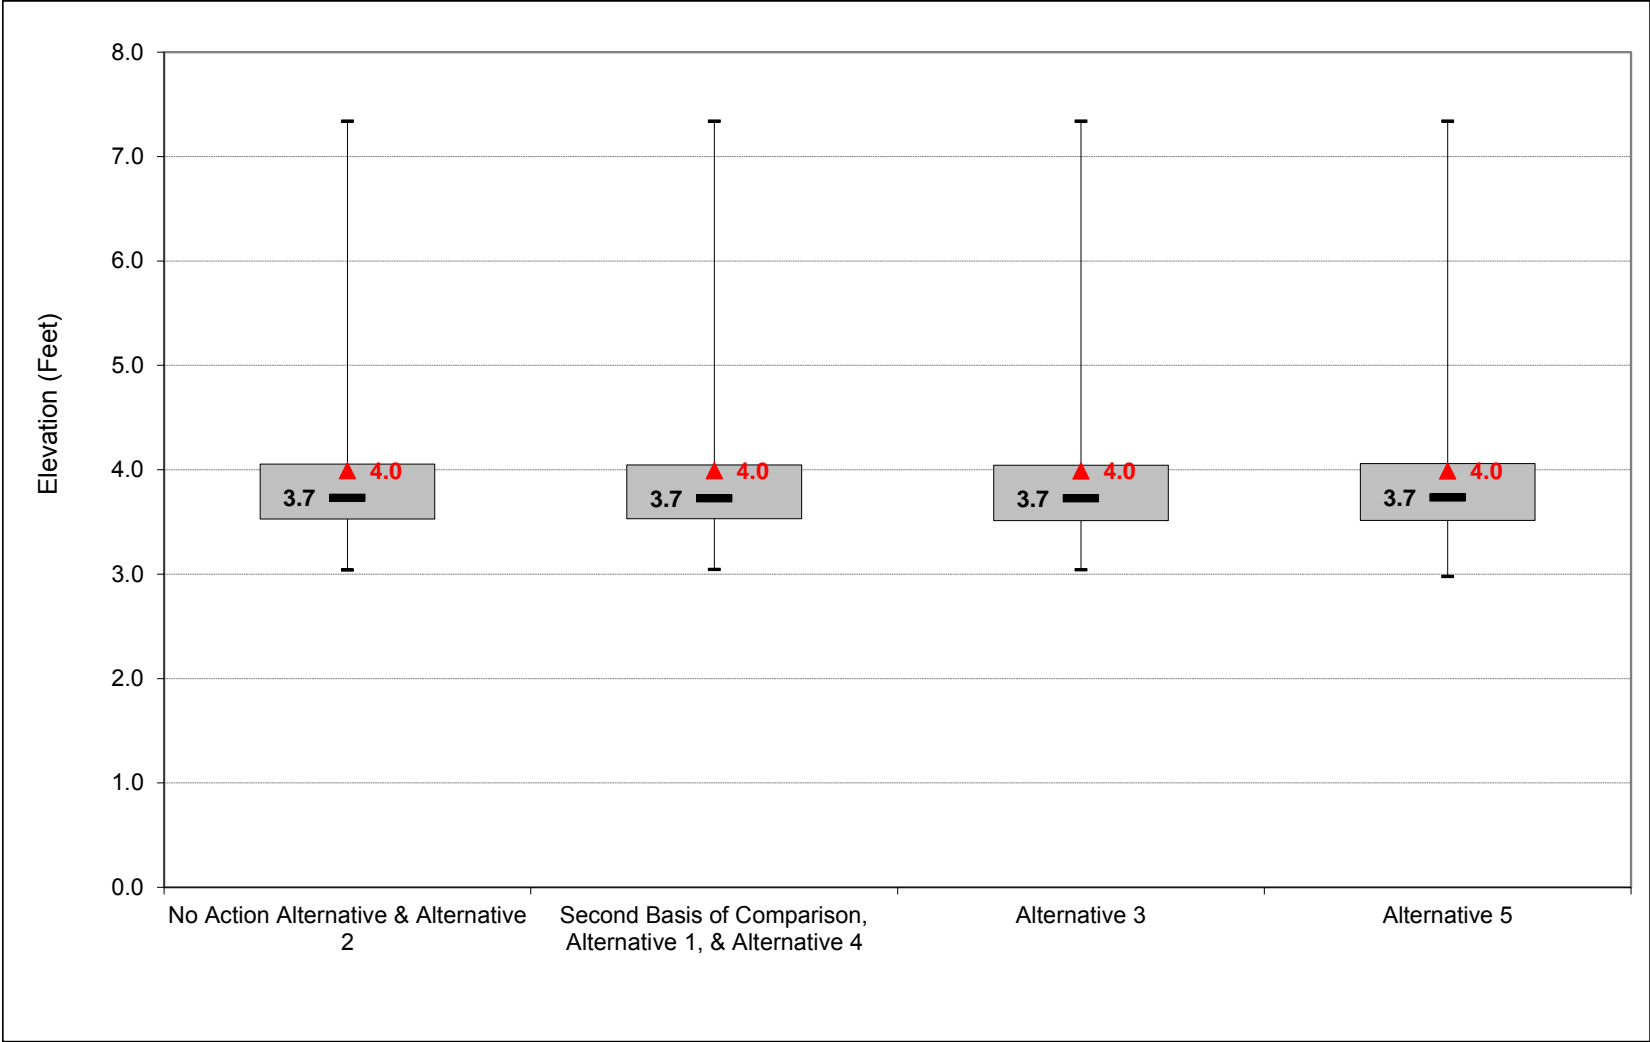


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-40-1-9. Steamboat Sl d/s of Sutter Sl, Monthly Averaged Daily Maximum Elevation, June

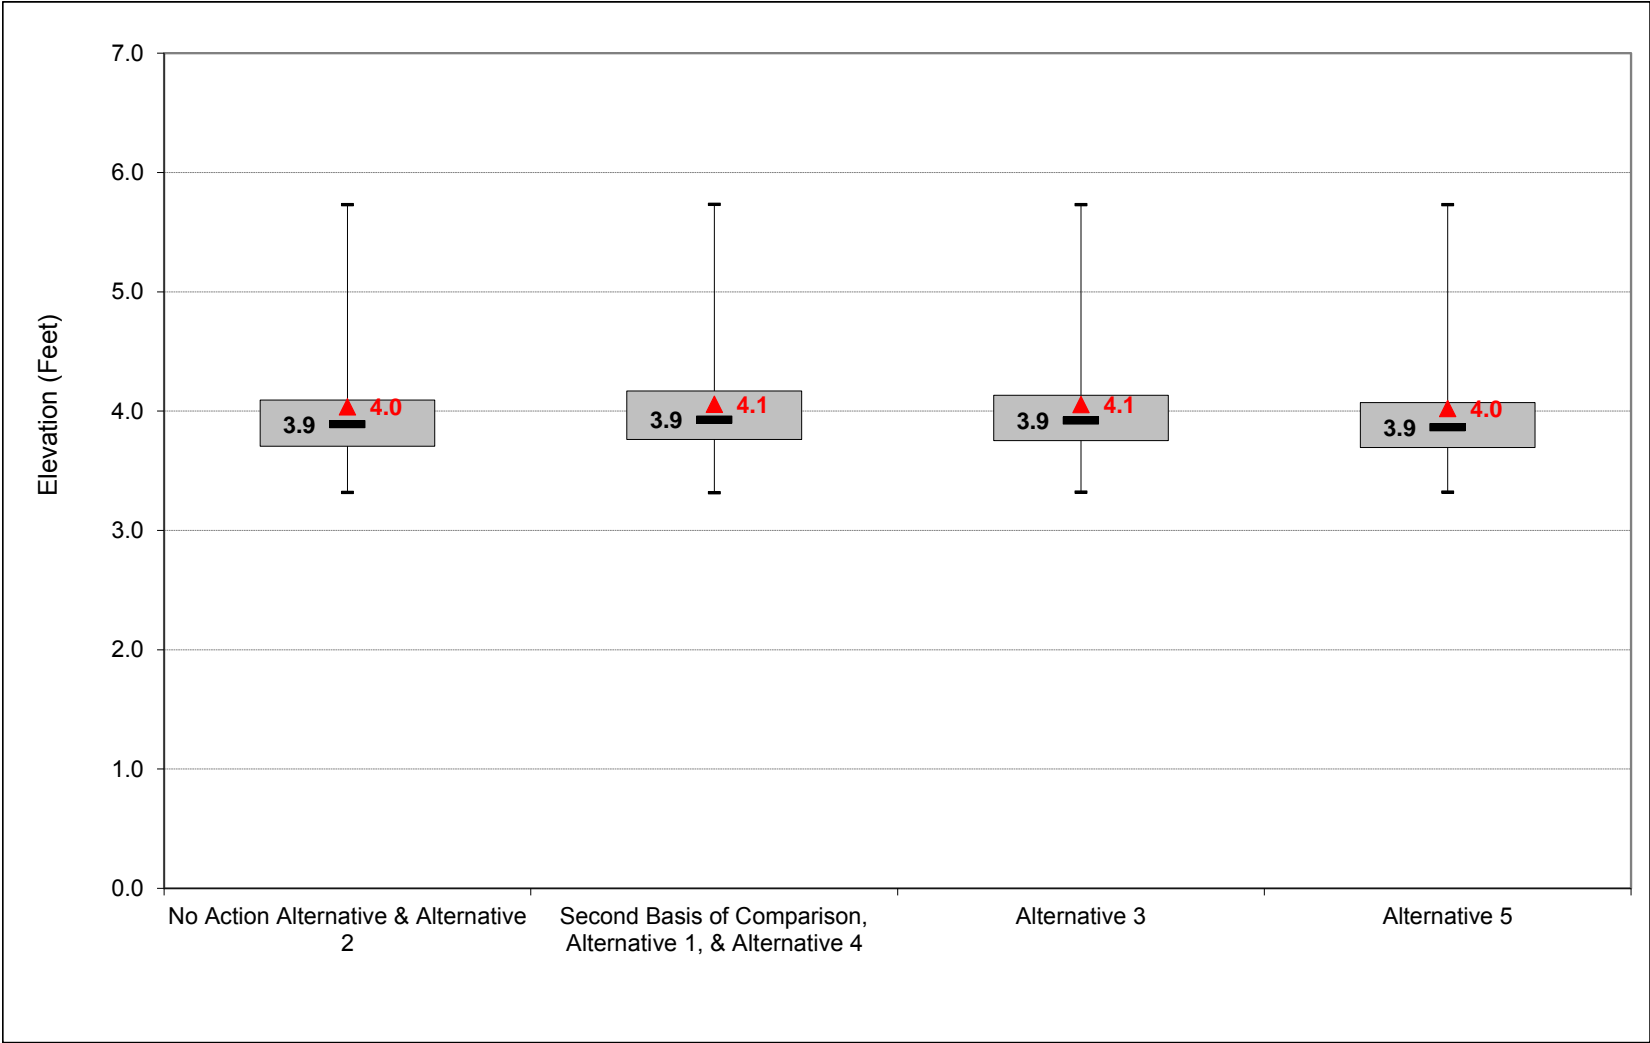


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-40-1-10. Steamboat Sl d/s of Sutter Sl, Monthly Averaged Daily Maximum Elevation, July

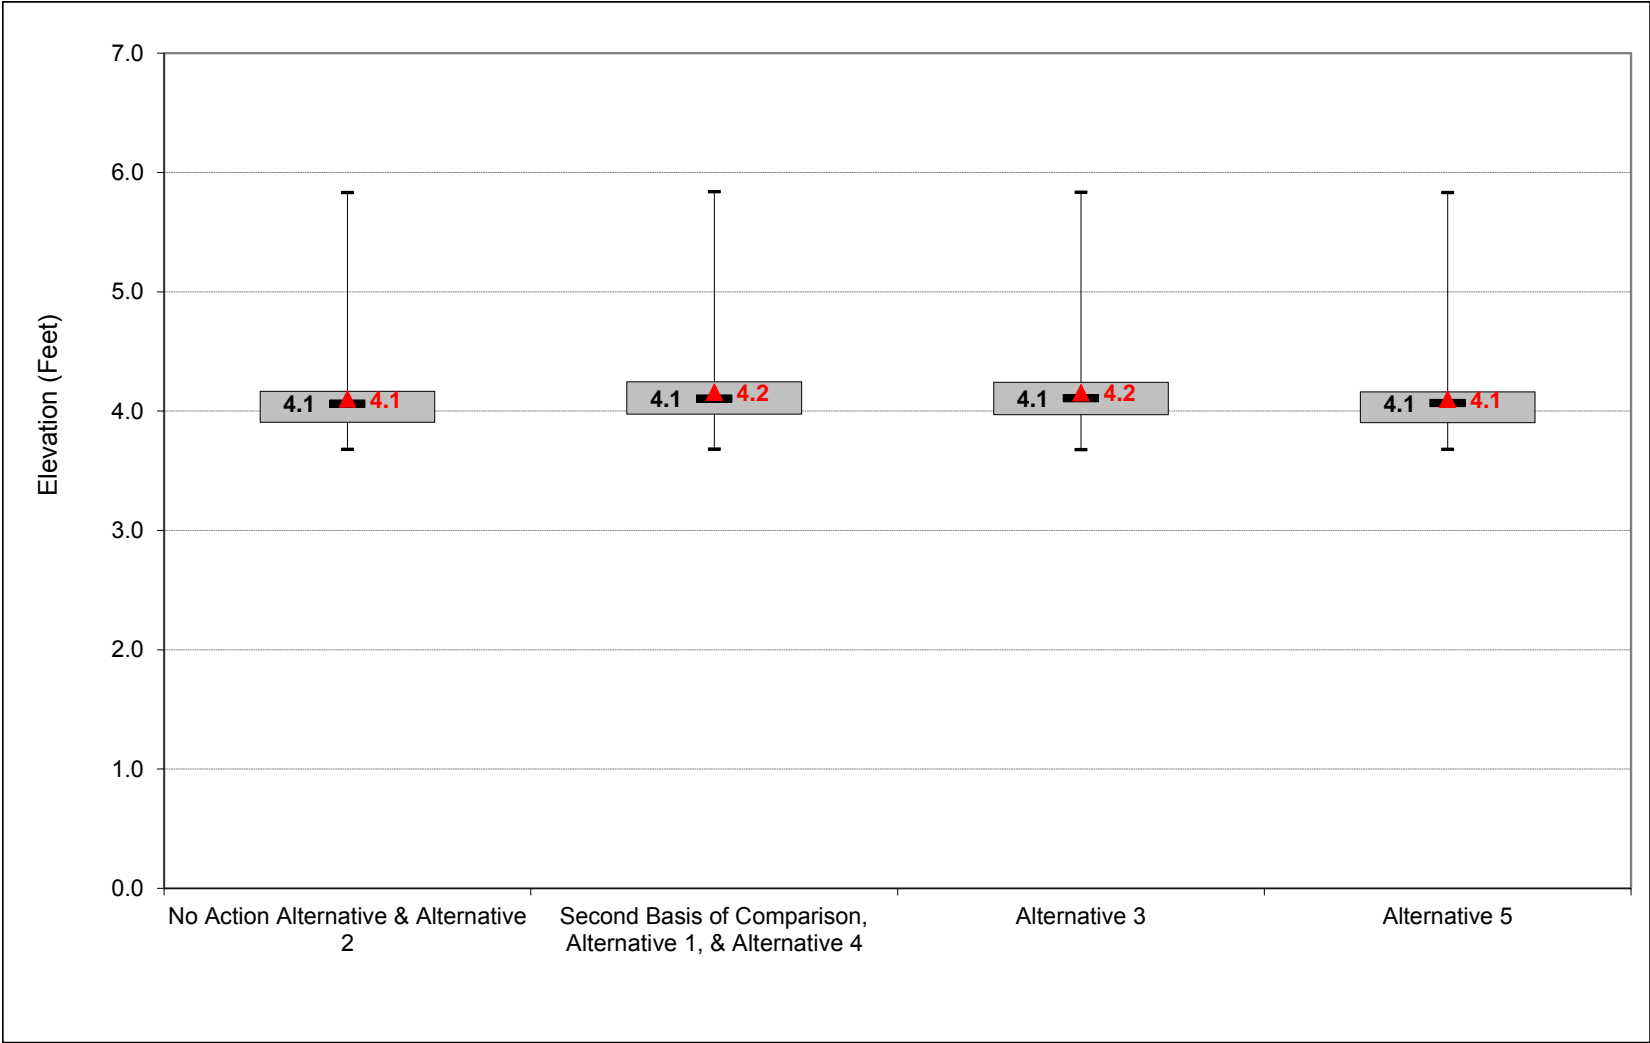


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-40-1-11. Steamboat Sl d/s of Sutter Sl, Monthly Averaged Daily Maximum Elevation, August

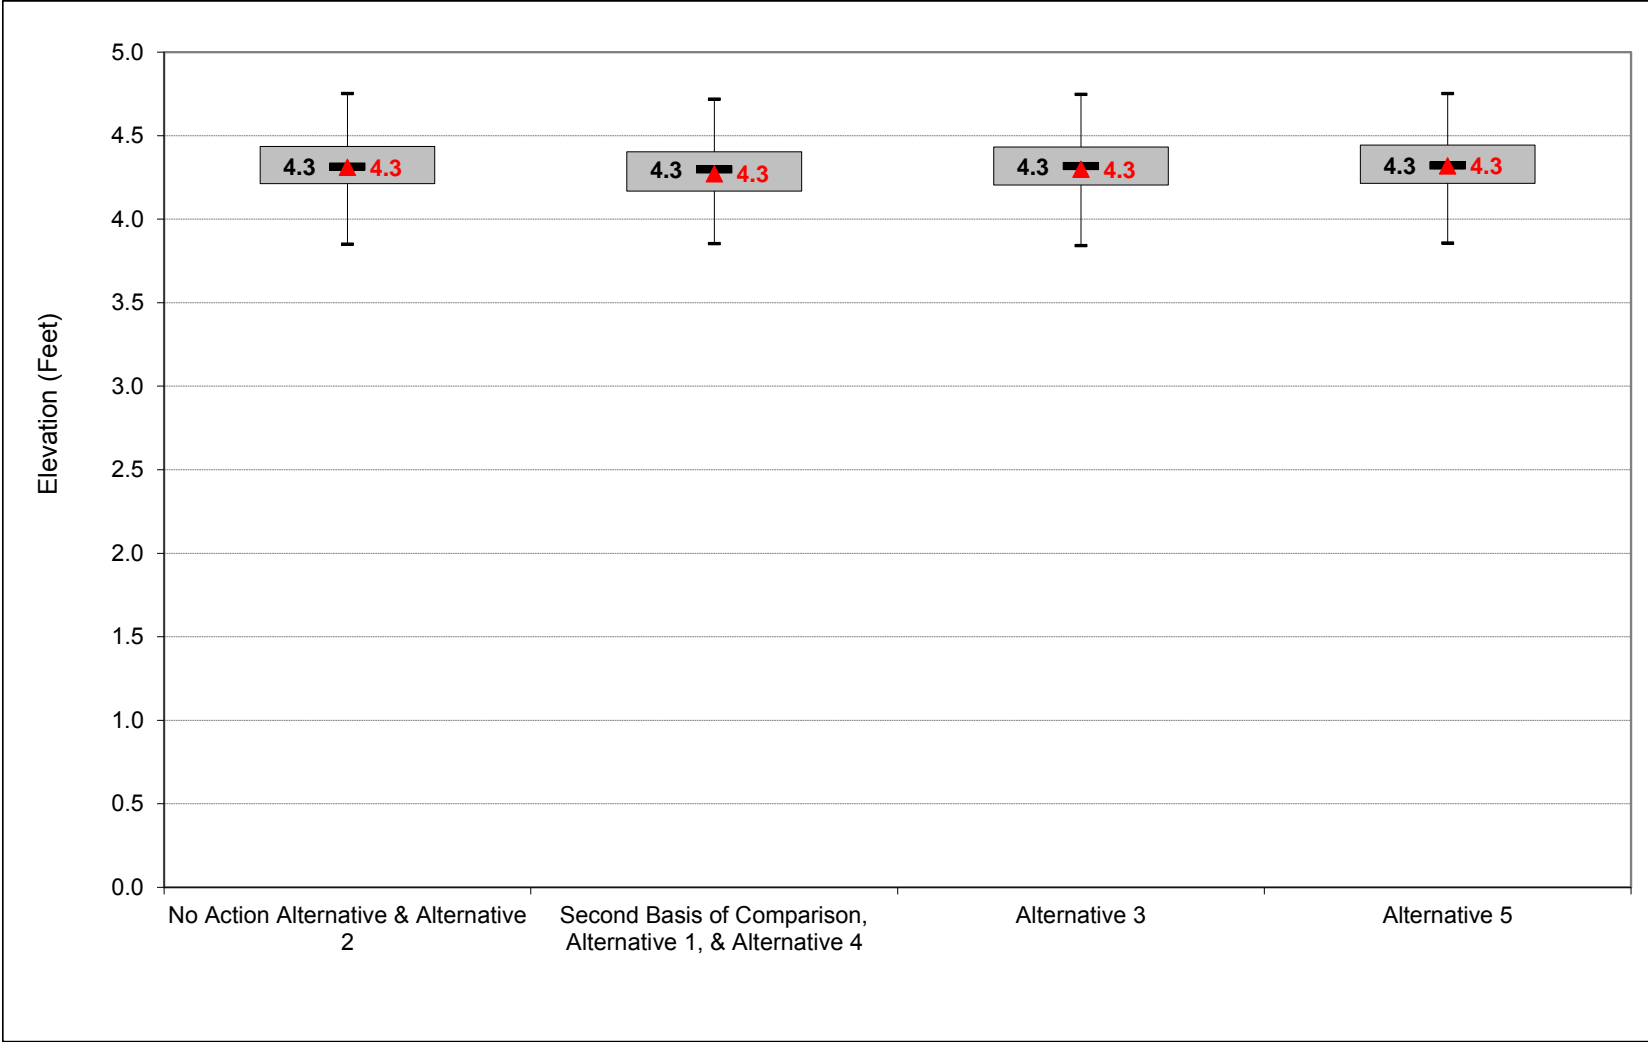

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-40-1-12. Steamboat Sl d/s of Sutter Sl, Monthly Averaged Daily Maximum Elevation, September

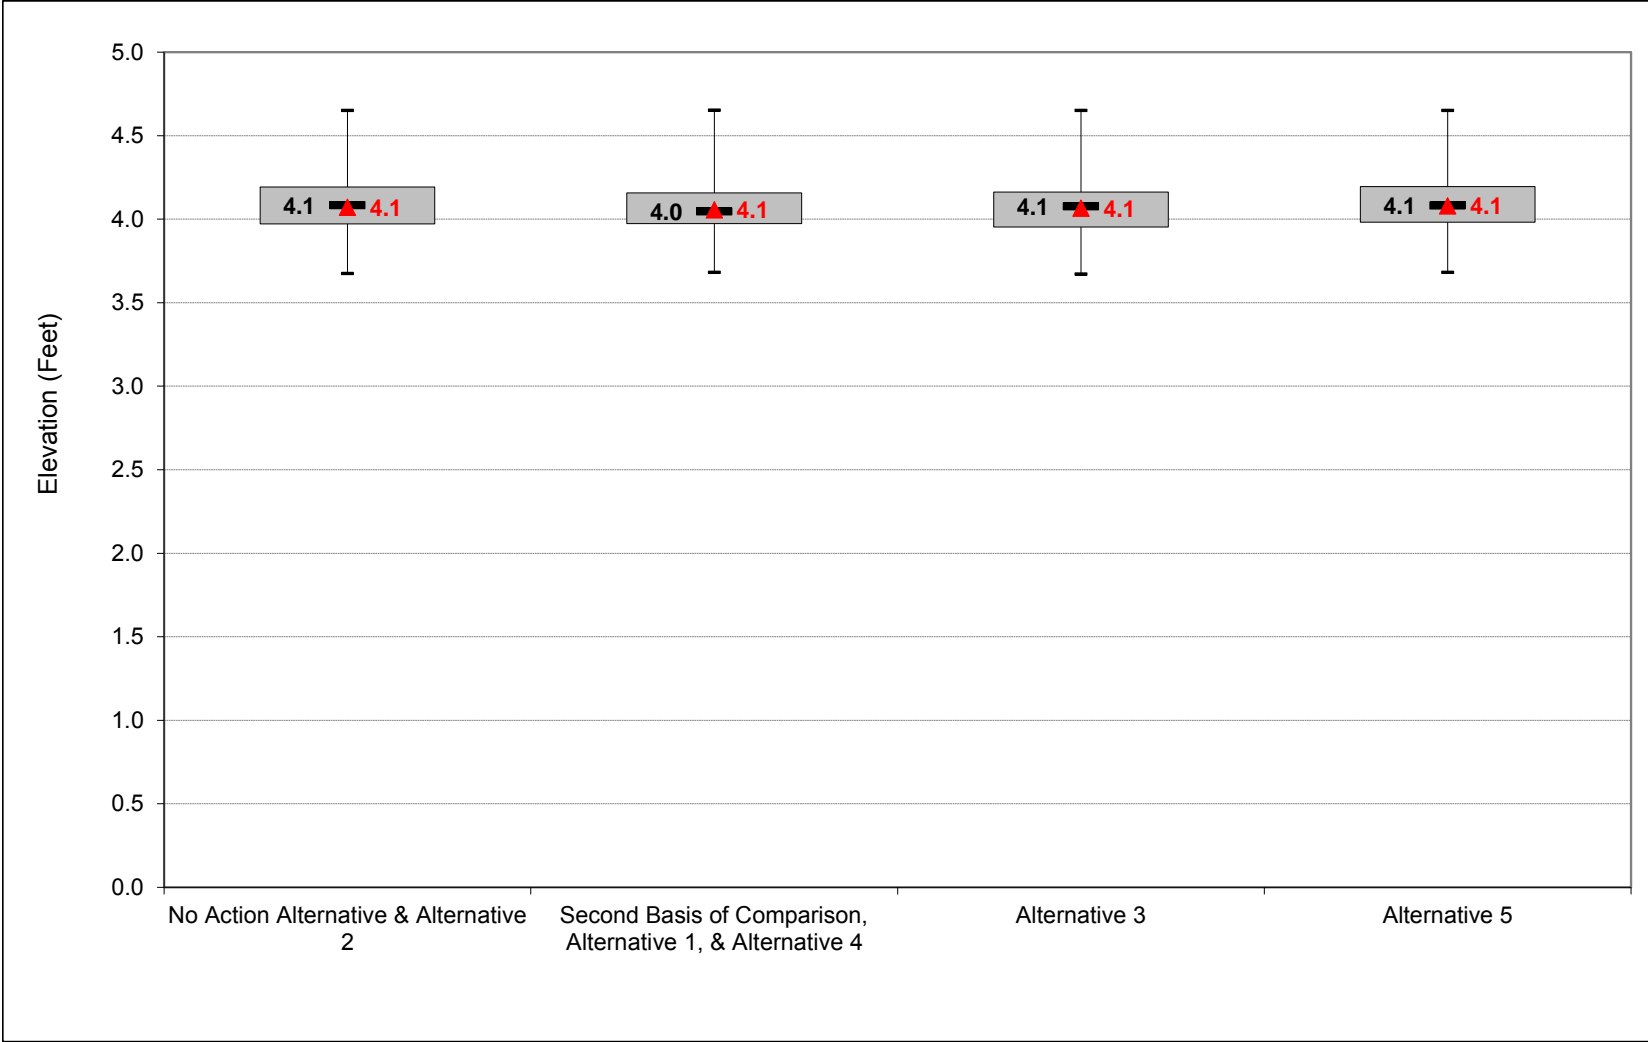

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-40-1-1. Steamboat SI d/s of Sutter SI, Monthly Averaged Daily Maximum Elevation

No Action Alternative												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.9	4.4	5.6	6.8	7.1	6.4	5.3	4.7	4.4	4.5	4.2	4.5
20%	3.8	4.2	4.8	5.7	6.4	5.4	4.4	4.3	4.2	4.4	4.2	4.3
30%	3.8	4.0	4.3	5.0	5.6	4.5	3.9	4.1	4.1	4.4	4.2	4.2
40%	3.7	3.9	4.1	4.4	5.0	4.2	3.8	4.0	4.1	4.4	4.1	4.1
50%	3.7	3.8	4.1	4.3	4.5	4.0	3.7	3.9	4.1	4.3	4.1	4.0
60%	3.6	3.8	4.0	4.1	4.2	3.8	3.6	3.8	4.0	4.3	4.0	3.9
70%	3.6	3.7	3.9	4.0	4.1	3.7	3.6	3.8	3.9	4.3	4.0	3.8
80%	3.5	3.6	3.8	3.9	3.9	3.6	3.5	3.7	3.9	4.2	3.9	3.8
90%	3.4	3.5	3.7	3.8	3.8	3.5	3.4	3.6	3.8	4.1	3.9	3.7
Long Term												
Full Simulation Period ^b	3.7	3.9	4.4	4.8	5.0	4.5	4.0	4.0	4.1	4.3	4.1	4.0
Water Year Types ^c												
Wet (32%)	3.8	4.2	5.1	5.8	6.1	5.4	4.6	4.5	4.3	4.4	4.2	4.4
Above Normal (16%)	3.6	4.0	4.5	5.1	5.6	4.8	4.0	4.0	4.1	4.4	4.2	4.1
Below Normal (13%)	3.7	3.9	4.1	4.1	4.5	3.7	3.6	3.8	4.0	4.4	4.1	3.9
Dry (24%)	3.6	3.7	3.9	4.0	4.1	3.9	3.6	3.8	4.0	4.2	4.0	3.8
Critical (15%)	3.6	3.7	3.9	4.0	3.9	3.6	3.5	3.7	3.9	4.1	3.9	3.7

Alternative 1												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.9	4.3	5.9	6.8	7.2	6.5	5.3	4.7	4.5	4.4	4.2	4.1
20%	3.8	4.0	4.9	6.0	6.4	5.4	4.4	4.3	4.3	4.4	4.2	4.0
30%	3.7	3.9	4.3	5.0	5.6	4.8	3.9	4.1	4.2	4.4	4.1	4.0
40%	3.7	3.8	4.1	4.4	5.2	4.2	3.8	4.0	4.1	4.3	4.1	3.9
50%	3.7	3.7	4.0	4.3	4.5	4.0	3.7	3.9	4.1	4.3	4.0	3.9
60%	3.6	3.7	3.9	4.1	4.2	3.9	3.6	3.8	4.1	4.3	4.0	3.8
70%	3.6	3.6	3.9	4.0	4.1	3.7	3.6	3.8	4.0	4.2	4.0	3.8
80%	3.5	3.6	3.8	3.8	3.9	3.6	3.5	3.7	3.9	4.1	3.9	3.7
90%	3.4	3.5	3.7	3.7	3.7	3.5	3.3	3.6	3.9	4.0	3.9	3.7
Long Term												
Full Simulation Period ^b	3.7	3.8	4.4	4.8	5.0	4.5	4.0	4.1	4.2	4.3	4.1	3.9
Water Year Types ^c												
Wet (32%)	3.7	4.1	5.2	5.9	6.2	5.5	4.6	4.5	4.3	4.4	4.1	4.0
Above Normal (16%)	3.6	3.9	4.4	5.1	5.7	4.9	4.0	4.1	4.1	4.4	4.1	3.9
Below Normal (13%)	3.7	3.8	4.0	4.1	4.6	3.7	3.6	3.9	4.2	4.3	4.1	3.9
Dry (24%)	3.6	3.6	3.9	4.0	4.1	3.9	3.6	3.8	4.1	4.2	4.0	3.8
Critical (15%)	3.6	3.7	3.9	3.9	3.9	3.6	3.5	3.7	3.9	4.1	3.9	3.7

Alternative 1 minus No Action Alternative												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.0	0.4	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	-0.4
20%	0.0	-0.1	0.2	0.3	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-0.3
30%	0.0	-0.2	0.0	0.0	0.0	0.2	0.0	0.0	0.1	0.0	0.0	-0.2
40%	0.0	-0.1	0.0	0.0	0.2	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
60%	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
70%	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.0	-0.1
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-0.2
Water Year Types ^c												
Wet (32%)	0.0	-0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.4
Above Normal (16%)	0.0	-0.1	0.0	0.0	0.1	0.1	0.0	0.0	0.1	0.0	0.0	-0.2
Below Normal (13%)	0.0	-0.1	0.0	0.0	0.1	0.0	0.0	0.1	0.1	0.0	0.0	0.0
Dry (24%)	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-40-1-2. Steamboat SI d/s of Sutter SI, Monthly Averaged Daily Maximum Elevation

No Action Alternative

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.9	4.4	5.6	6.8	7.1	6.4	5.3	4.7	4.4	4.5	4.2	4.5
20%	3.8	4.2	4.8	5.7	6.4	5.4	4.4	4.3	4.2	4.4	4.2	4.3
30%	3.8	4.0	4.3	5.0	5.6	4.5	3.9	4.1	4.1	4.4	4.2	4.2
40%	3.7	3.9	4.1	4.4	5.0	4.2	3.8	4.0	4.1	4.4	4.1	4.1
50%	3.7	3.8	4.1	4.3	4.5	4.0	3.7	3.9	4.1	4.3	4.1	4.0
60%	3.6	3.8	4.0	4.1	4.2	3.8	3.6	3.8	4.0	4.3	4.0	3.9
70%	3.6	3.7	3.9	4.0	4.1	3.7	3.6	3.8	3.9	4.3	4.0	3.8
80%	3.5	3.6	3.8	3.9	3.9	3.6	3.5	3.7	3.9	4.2	3.9	3.8
90%	3.4	3.5	3.7	3.8	3.8	3.5	3.4	3.6	3.8	4.1	3.9	3.7
Long Term												
Full Simulation Period ^b	3.7	3.9	4.4	4.8	5.0	4.5	4.0	4.0	4.1	4.3	4.1	4.0
Water Year Types ^c												
Wet (32%)	3.8	4.2	5.1	5.8	6.1	5.4	4.6	4.5	4.3	4.4	4.2	4.4
Above Normal (16%)	3.6	4.0	4.5	5.1	5.6	4.8	4.0	4.0	4.1	4.4	4.2	4.1
Below Normal (13%)	3.7	3.9	4.1	4.1	4.5	3.7	3.6	3.8	4.0	4.4	4.1	3.9
Dry (24%)	3.6	3.7	3.9	4.0	4.1	3.9	3.6	3.8	4.0	4.2	4.0	3.8
Critical (15%)	3.6	3.7	3.9	4.0	3.9	3.6	3.5	3.7	3.9	4.1	3.9	3.7

Alternative 3

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.9	4.3	5.9	6.8	7.2	6.5	5.3	4.7	4.4	4.5	4.2	4.1
20%	3.8	4.0	5.0	6.0	6.4	5.4	4.4	4.3	4.3	4.4	4.2	4.0
30%	3.7	3.8	4.3	5.0	5.6	4.7	3.9	4.1	4.2	4.4	4.1	4.0
40%	3.7	3.8	4.1	4.5	5.2	4.2	3.8	4.0	4.2	4.3	4.1	3.9
50%	3.7	3.7	4.0	4.3	4.5	4.0	3.7	3.9	4.1	4.3	4.1	3.9
60%	3.6	3.7	3.9	4.1	4.2	3.9	3.6	3.8	4.1	4.3	4.0	3.8
70%	3.5	3.6	3.9	4.0	4.1	3.7	3.6	3.8	4.0	4.2	4.0	3.8
80%	3.5	3.6	3.8	3.9	3.9	3.6	3.5	3.7	4.0	4.2	3.9	3.7
90%	3.4	3.5	3.7	3.7	3.7	3.5	3.4	3.6	3.9	4.0	3.9	3.7
Long Term												
Full Simulation Period ^b	3.7	3.8	4.4	4.8	5.1	4.5	4.0	4.1	4.2	4.3	4.1	3.9
Water Year Types ^c												
Wet (32%)	3.7	4.1	5.2	5.9	6.1	5.5	4.6	4.5	4.4	4.4	4.1	4.0
Above Normal (16%)	3.6	3.9	4.4	5.1	5.7	4.9	4.0	4.1	4.1	4.4	4.1	3.9
Below Normal (13%)	3.7	3.8	4.0	4.1	4.6	3.7	3.6	3.8	4.1	4.4	4.2	3.9
Dry (24%)	3.6	3.6	3.9	4.0	4.1	3.9	3.6	3.8	4.1	4.2	4.0	3.8
Critical (15%)	3.6	3.6	3.9	3.9	3.9	3.6	3.5	3.7	4.0	4.1	3.9	3.7

Alternative 3 minus No Action Alternative

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.1	-0.1	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.4
20%	-0.1	-0.1	0.2	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.3
30%	0.0	-0.2	0.0	0.0	0.1	0.1	0.0	0.0	0.1	0.0	0.0	-0.3
40%	0.0	-0.1	0.0	0.0	0.2	0.1	0.0	0.0	0.1	0.0	0.0	-0.1
50%	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
60%	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-0.1
70%	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-0.1
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-0.2
Water Year Types ^c												
Wet (32%)	0.0	-0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.4
Above Normal (16%)	0.0	-0.1	0.0	0.0	0.1	0.1	0.0	0.0	0.1	0.0	0.0	-0.2
Below Normal (13%)	0.0	-0.1	0.0	0.0	0.1	0.0	0.0	0.0	0.1	0.0	0.0	0.0
Dry (24%)	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-40-1-3. Steamboat SI d/s of Sutter SI, Monthly Averaged Daily Maximum Elevation

No Action Alternative												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3.9	4.4	5.6	6.8	7.1	6.4	5.3	4.7	4.4	4.5	4.2	4.5
20%	3.8	4.2	4.8	5.7	6.4	5.4	4.4	4.3	4.2	4.4	4.2	4.3
30%	3.8	4.0	4.3	5.0	5.6	4.5	3.9	4.1	4.1	4.4	4.2	4.2
40%	3.7	3.9	4.1	4.4	5.0	4.2	3.8	4.0	4.1	4.4	4.1	4.1
50%	3.7	3.8	4.1	4.3	4.5	4.0	3.7	3.9	4.1	4.3	4.1	4.0
60%	3.6	3.8	4.0	4.1	4.2	3.8	3.6	3.8	4.0	4.3	4.0	3.9
70%	3.6	3.7	3.9	4.0	4.1	3.7	3.6	3.8	3.9	4.3	4.0	3.8
80%	3.5	3.6	3.8	3.9	3.9	3.6	3.5	3.7	3.9	4.2	3.9	3.8
90%	3.4	3.5	3.7	3.8	3.8	3.5	3.4	3.6	3.8	4.1	3.9	3.7
Long Term												
Full Simulation Period ^b	3.7	3.9	4.4	4.8	5.0	4.5	4.0	4.0	4.1	4.3	4.1	4.0
Water Year Types^c												
Wet (32%)	3.8	4.2	5.1	5.8	6.1	5.4	4.6	4.5	4.3	4.4	4.2	4.4
Above Normal (16%)	3.6	4.0	4.5	5.1	5.6	4.8	4.0	4.0	4.1	4.4	4.2	4.1
Below Normal (13%)	3.7	3.9	4.1	4.1	4.5	3.7	3.6	3.8	4.0	4.4	4.1	3.9
Dry (24%)	3.6	3.7	3.9	4.0	4.1	3.9	3.6	3.8	4.0	4.2	4.0	3.8
Critical (15%)	3.6	3.7	3.9	4.0	3.9	3.6	3.5	3.7	3.9	4.1	3.9	3.7

Alternative 5												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3.9	4.4	5.6	6.8	7.1	6.4	5.3	4.7	4.4	4.5	4.3	4.5
20%	3.8	4.2	4.8	5.7	6.4	5.4	4.4	4.3	4.2	4.5	4.2	4.3
30%	3.7	4.0	4.3	5.0	5.6	4.5	3.9	4.0	4.1	4.4	4.2	4.2
40%	3.7	3.9	4.1	4.4	5.0	4.2	3.8	4.0	4.1	4.4	4.1	4.1
50%	3.7	3.8	4.1	4.3	4.5	4.0	3.7	3.9	4.1	4.3	4.1	4.0
60%	3.6	3.8	4.0	4.1	4.2	3.8	3.6	3.8	4.0	4.3	4.0	3.9
70%	3.6	3.7	3.9	4.0	4.1	3.7	3.6	3.7	3.9	4.2	4.0	3.8
80%	3.5	3.6	3.8	3.9	3.9	3.6	3.5	3.6	3.9	4.2	3.9	3.8
90%	3.4	3.5	3.7	3.8	3.8	3.5	3.3	3.6	3.8	4.1	3.9	3.7
Long Term												
Full Simulation Period ^b	3.7	3.9	4.4	4.8	5.0	4.5	4.0	4.0	4.1	4.3	4.1	4.0
Water Year Types^c												
Wet (32%)	3.8	4.2	5.1	5.8	6.1	5.4	4.6	4.5	4.3	4.4	4.2	4.4
Above Normal (16%)	3.7	4.0	4.5	5.1	5.6	4.8	4.0	4.0	4.1	4.4	4.1	4.1
Below Normal (13%)	3.7	3.9	4.1	4.1	4.5	3.7	3.6	3.8	4.0	4.4	4.2	3.9
Dry (24%)	3.6	3.7	3.9	4.0	4.1	3.9	3.6	3.8	4.0	4.2	4.0	3.8
Critical (15%)	3.6	3.7	3.9	4.0	3.9	3.6	3.5	3.6	3.9	4.1	3.9	3.7

Alternative 5 minus No Action Alternative												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
30%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-40-1-4. Steamboat SI d/s of Sutter SI, Monthly Averaged Daily Maximum Elevation

Second Basis of Comparison												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3.9	4.3	5.9	6.8	7.2	6.5	5.3	4.7	4.5	4.4	4.2	4.1
20%	3.8	4.0	4.9	6.0	6.4	5.4	4.4	4.3	4.3	4.4	4.2	4.0
30%	3.7	3.9	4.3	5.0	5.6	4.8	3.9	4.1	4.2	4.4	4.1	4.0
40%	3.7	3.8	4.1	4.4	5.2	4.2	3.8	4.0	4.1	4.3	4.1	3.9
50%	3.7	3.7	4.0	4.3	4.5	4.0	3.7	3.9	4.1	4.3	4.0	3.9
60%	3.6	3.7	3.9	4.1	4.2	3.9	3.6	3.8	4.1	4.3	4.0	3.8
70%	3.6	3.6	3.9	4.0	4.1	3.7	3.6	3.8	4.0	4.2	4.0	3.8
80%	3.5	3.6	3.8	3.8	3.9	3.6	3.5	3.7	3.9	4.1	3.9	3.7
90%	3.4	3.5	3.7	3.7	3.7	3.5	3.3	3.6	3.9	4.0	3.9	3.7
Long Term												
Full Simulation Period ^b	3.7	3.8	4.4	4.8	5.0	4.5	4.0	4.1	4.2	4.3	4.1	3.9
Water Year Types^c												
Wet (32%)	3.7	4.1	5.2	5.9	6.2	5.5	4.6	4.5	4.3	4.4	4.1	4.0
Above Normal (16%)	3.6	3.9	4.4	5.1	5.7	4.9	4.0	4.1	4.1	4.4	4.1	3.9
Below Normal (13%)	3.7	3.8	4.0	4.1	4.6	3.7	3.6	3.9	4.2	4.3	4.1	3.9
Dry (24%)	3.6	3.6	3.9	4.0	4.1	3.9	3.6	3.8	4.1	4.2	4.0	3.8
Critical (15%)	3.6	3.7	3.9	3.9	3.9	3.6	3.5	3.7	3.9	4.1	3.9	3.7

No Action Alternative												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3.9	4.4	5.6	6.8	7.1	6.4	5.3	4.7	4.4	4.5	4.2	4.5
20%	3.8	4.2	4.8	5.7	6.4	5.4	4.4	4.3	4.2	4.4	4.2	4.3
30%	3.8	4.0	4.3	5.0	5.6	4.5	3.9	4.1	4.1	4.4	4.2	4.2
40%	3.7	3.9	4.1	4.4	5.0	4.2	3.8	4.0	4.1	4.4	4.1	4.1
50%	3.7	3.8	4.1	4.3	4.5	4.0	3.7	3.9	4.1	4.3	4.1	4.0
60%	3.6	3.8	4.0	4.1	4.2	3.8	3.6	3.8	4.0	4.3	4.0	3.9
70%	3.6	3.7	3.9	4.0	4.1	3.7	3.6	3.8	3.9	4.3	4.0	3.8
80%	3.5	3.6	3.8	3.9	3.9	3.6	3.5	3.7	3.9	4.2	3.9	3.8
90%	3.4	3.5	3.7	3.8	3.8	3.5	3.4	3.6	3.8	4.1	3.9	3.7
Long Term												
Full Simulation Period ^b	3.7	3.9	4.4	4.8	5.0	4.5	4.0	4.0	4.1	4.3	4.1	4.0
Water Year Types^c												
Wet (32%)	3.8	4.2	5.1	5.8	6.1	5.4	4.6	4.5	4.3	4.4	4.2	4.4
Above Normal (16%)	3.6	4.0	4.5	5.1	5.6	4.8	4.0	4.0	4.1	4.4	4.2	4.1
Below Normal (13%)	3.7	3.9	4.1	4.1	4.5	3.7	3.6	3.8	4.0	4.4	4.1	3.9
Dry (24%)	3.6	3.7	3.9	4.0	4.1	3.9	3.6	3.8	4.0	4.2	4.0	3.8
Critical (15%)	3.6	3.7	3.9	4.0	3.9	3.6	3.5	3.7	3.9	4.1	3.9	3.7

No Action Alternative minus Second Basis of Comparison												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.0	0.0	-0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.4
20%	0.0	0.1	-0.2	-0.3	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.3
30%	0.0	0.2	0.0	0.0	0.0	-0.2	0.0	0.0	0.0	-0.1	0.0	0.2
40%	0.0	0.1	0.0	0.0	-0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.1
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
60%	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
70%	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.0	0.1
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.2
Water Year Types^c												
Wet (32%)	0.0	0.1	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.4
Above Normal (16%)	0.0	0.1	0.0	0.0	-0.1	-0.1	0.0	0.0	-0.1	0.0	0.0	0.2
Below Normal (13%)	0.0	0.1	0.0	0.0	-0.1	0.0	0.0	-0.1	-0.1	0.0	0.0	0.0
Dry (24%)	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-40-1-5. Steamboat SI d/s of Sutter SI, Monthly Averaged Daily Maximum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.9	4.3	5.9	6.8	7.2	6.5	5.3	4.7	4.5	4.4	4.2	4.1
20%	3.8	4.0	4.9	6.0	6.4	5.4	4.4	4.3	4.3	4.4	4.2	4.0
30%	3.7	3.9	4.3	5.0	5.6	4.8	3.9	4.1	4.2	4.4	4.1	4.0
40%	3.7	3.8	4.1	4.4	5.2	4.2	3.8	4.0	4.1	4.3	4.1	3.9
50%	3.7	3.7	4.0	4.3	4.5	4.0	3.7	3.9	4.1	4.3	4.0	3.9
60%	3.6	3.7	3.9	4.1	4.2	3.9	3.6	3.8	4.1	4.3	4.0	3.8
70%	3.6	3.6	3.9	4.0	4.1	3.7	3.6	3.8	4.0	4.2	4.0	3.8
80%	3.5	3.6	3.8	3.8	3.9	3.6	3.5	3.7	3.9	4.1	3.9	3.7
90%	3.4	3.5	3.7	3.7	3.7	3.5	3.3	3.6	3.9	4.0	3.9	3.7
Long Term												
Full Simulation Period ^b	3.7	3.8	4.4	4.8	5.0	4.5	4.0	4.1	4.2	4.3	4.1	3.9
Water Year Types ^c												
Wet (32%)	3.7	4.1	5.2	5.9	6.2	5.5	4.6	4.5	4.3	4.4	4.1	4.0
Above Normal (16%)	3.6	3.9	4.4	5.1	5.7	4.9	4.0	4.1	4.1	4.4	4.1	3.9
Below Normal (13%)	3.7	3.8	4.0	4.1	4.6	3.7	3.6	3.9	4.2	4.3	4.1	3.9
Dry (24%)	3.6	3.6	3.9	4.0	4.1	3.9	3.6	3.8	4.1	4.2	4.0	3.8
Critical (15%)	3.6	3.7	3.9	3.9	3.9	3.6	3.5	3.7	3.9	4.1	3.9	3.7

Alternative 3

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.9	4.3	5.9	6.8	7.2	6.5	5.3	4.7	4.4	4.5	4.2	4.1
20%	3.8	4.0	5.0	6.0	6.4	5.4	4.4	4.3	4.3	4.4	4.2	4.0
30%	3.7	3.8	4.3	5.0	5.6	4.7	3.9	4.1	4.2	4.4	4.1	4.0
40%	3.7	3.8	4.1	4.5	5.2	4.2	3.8	4.0	4.2	4.3	4.1	3.9
50%	3.7	3.7	4.0	4.3	4.5	4.0	3.7	3.9	4.1	4.3	4.1	3.9
60%	3.6	3.7	3.9	4.1	4.2	3.9	3.6	3.8	4.1	4.3	4.0	3.8
70%	3.5	3.6	3.9	4.0	4.1	3.7	3.6	3.8	4.0	4.2	4.0	3.8
80%	3.5	3.6	3.8	3.9	3.9	3.6	3.5	3.7	4.0	4.2	3.9	3.7
90%	3.4	3.5	3.7	3.7	3.7	3.5	3.4	3.6	3.9	4.0	3.9	3.7
Long Term												
Full Simulation Period ^b	3.7	3.8	4.4	4.8	5.1	4.5	4.0	4.1	4.2	4.3	4.1	3.9
Water Year Types ^c												
Wet (32%)	3.7	4.1	5.2	5.9	6.1	5.5	4.6	4.5	4.4	4.4	4.1	4.0
Above Normal (16%)	3.6	3.9	4.4	5.1	5.7	4.9	4.0	4.1	4.1	4.4	4.1	3.9
Below Normal (13%)	3.7	3.8	4.0	4.1	4.6	3.7	3.6	3.8	4.1	4.4	4.2	3.9
Dry (24%)	3.6	3.6	3.9	4.0	4.1	3.9	3.6	3.8	4.1	4.2	4.0	3.8
Critical (15%)	3.6	3.6	3.9	3.9	3.9	3.6	3.5	3.7	4.0	4.1	3.9	3.7

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
30%	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.1	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-40-1-6. Steamboat SI d/s of Sutter SI, Monthly Averaged Daily Maximum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.9	4.3	5.9	6.8	7.2	6.5	5.3	4.7	4.5	4.4	4.2	4.1
20%	3.8	4.0	4.9	6.0	6.4	5.4	4.4	4.3	4.3	4.4	4.2	4.0
30%	3.7	3.9	4.3	5.0	5.6	4.8	3.9	4.1	4.2	4.4	4.1	4.0
40%	3.7	3.8	4.1	4.4	5.2	4.2	3.8	4.0	4.1	4.3	4.1	3.9
50%	3.7	3.7	4.0	4.3	4.5	4.0	3.7	3.9	4.1	4.3	4.0	3.9
60%	3.6	3.7	3.9	4.1	4.2	3.9	3.6	3.8	4.1	4.3	4.0	3.8
70%	3.6	3.6	3.9	4.0	4.1	3.7	3.6	3.8	4.0	4.2	4.0	3.8
80%	3.5	3.6	3.8	3.8	3.9	3.6	3.5	3.7	3.9	4.1	3.9	3.7
90%	3.4	3.5	3.7	3.7	3.7	3.5	3.3	3.6	3.9	4.0	3.9	3.7
Long Term												
Full Simulation Period ^b	3.7	3.8	4.4	4.8	5.0	4.5	4.0	4.1	4.2	4.3	4.1	3.9
Water Year Types ^c												
Wet (32%)	3.7	4.1	5.2	5.9	6.2	5.5	4.6	4.5	4.3	4.4	4.1	4.0
Above Normal (16%)	3.6	3.9	4.4	5.1	5.7	4.9	4.0	4.1	4.1	4.4	4.1	3.9
Below Normal (13%)	3.7	3.8	4.0	4.1	4.6	3.7	3.6	3.9	4.2	4.3	4.1	3.9
Dry (24%)	3.6	3.6	3.9	4.0	4.1	3.9	3.6	3.8	4.1	4.2	4.0	3.8
Critical (15%)	3.6	3.7	3.9	3.9	3.9	3.6	3.5	3.7	3.9	4.1	3.9	3.7

Alternative 5

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.9	4.4	5.6	6.8	7.1	6.4	5.3	4.7	4.4	4.5	4.3	4.5
20%	3.8	4.2	4.8	5.7	6.4	5.4	4.4	4.3	4.2	4.5	4.2	4.3
30%	3.7	4.0	4.3	5.0	5.6	4.5	3.9	4.0	4.1	4.4	4.2	4.2
40%	3.7	3.9	4.1	4.4	5.0	4.2	3.8	4.0	4.1	4.4	4.1	4.1
50%	3.7	3.8	4.1	4.3	4.5	4.0	3.7	3.9	4.1	4.3	4.1	4.0
60%	3.6	3.8	4.0	4.1	4.2	3.8	3.6	3.8	4.0	4.3	4.0	3.9
70%	3.6	3.7	3.9	4.0	4.1	3.7	3.6	3.7	3.9	4.2	4.0	3.8
80%	3.5	3.6	3.8	3.9	3.9	3.6	3.5	3.6	3.9	4.2	3.9	3.8
90%	3.4	3.5	3.7	3.8	3.8	3.5	3.3	3.6	3.8	4.1	3.9	3.7
Long Term												
Full Simulation Period ^b	3.7	3.9	4.4	4.8	5.0	4.5	4.0	4.0	4.1	4.3	4.1	4.0
Water Year Types ^c												
Wet (32%)	3.8	4.2	5.1	5.8	6.1	5.4	4.6	4.5	4.3	4.4	4.2	4.4
Above Normal (16%)	3.7	4.0	4.5	5.1	5.6	4.8	4.0	4.0	4.1	4.4	4.1	4.1
Below Normal (13%)	3.7	3.9	4.1	4.1	4.5	3.7	3.6	3.8	4.0	4.4	4.2	3.9
Dry (24%)	3.6	3.7	3.9	4.0	4.1	3.9	3.6	3.8	4.0	4.2	4.0	3.8
Critical (15%)	3.6	3.7	3.9	4.0	3.9	3.6	3.5	3.6	3.9	4.1	3.9	3.7

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.0	-0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.4
20%	0.0	0.1	-0.2	-0.3	0.0	0.0	0.0	0.0	-0.1	0.0	0.1	0.3
30%	0.0	0.2	0.0	0.0	0.0	-0.2	0.0	0.0	-0.1	0.0	0.0	0.2
40%	0.0	0.1	0.0	0.0	-0.1	0.0	0.0	0.0	-0.1	0.0	0.0	0.1
50%	0.0	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.1
60%	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
70%	0.0	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.1	0.0	0.1
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.1
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.2
Water Year Types ^c												
Wet (32%)	0.0	0.1	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.4
Above Normal (16%)	0.0	0.1	0.0	0.0	-0.1	-0.1	0.0	0.0	-0.1	0.0	0.0	0.2
Below Normal (13%)	0.0	0.1	0.0	0.0	-0.1	0.0	0.0	-0.1	-0.1	0.0	0.0	0.0
Dry (24%)	0.0	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.1	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0


a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-40-2-1. Steamboat SI d/s of Sutter SI, Monthly Averaged Daily Minimum Elevation, October

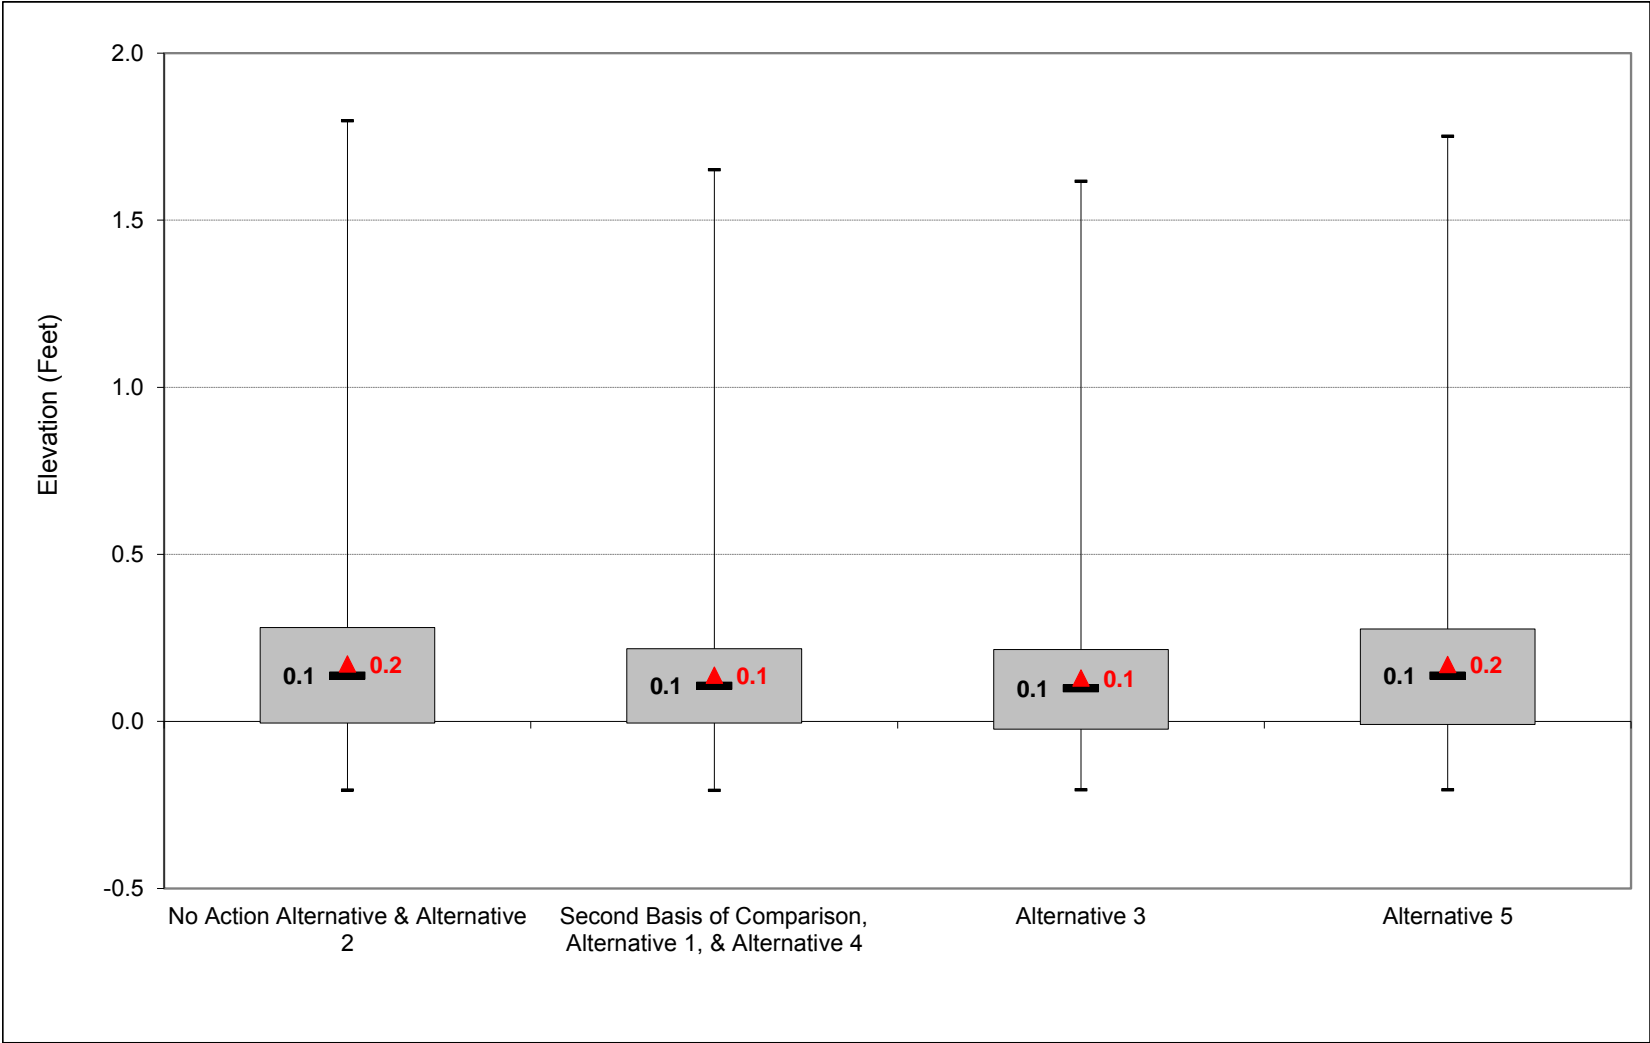


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-40-2-2. Steamboat Sl d/s of Sutter Sl, Monthly Averaged Daily Minimum Elevation, November

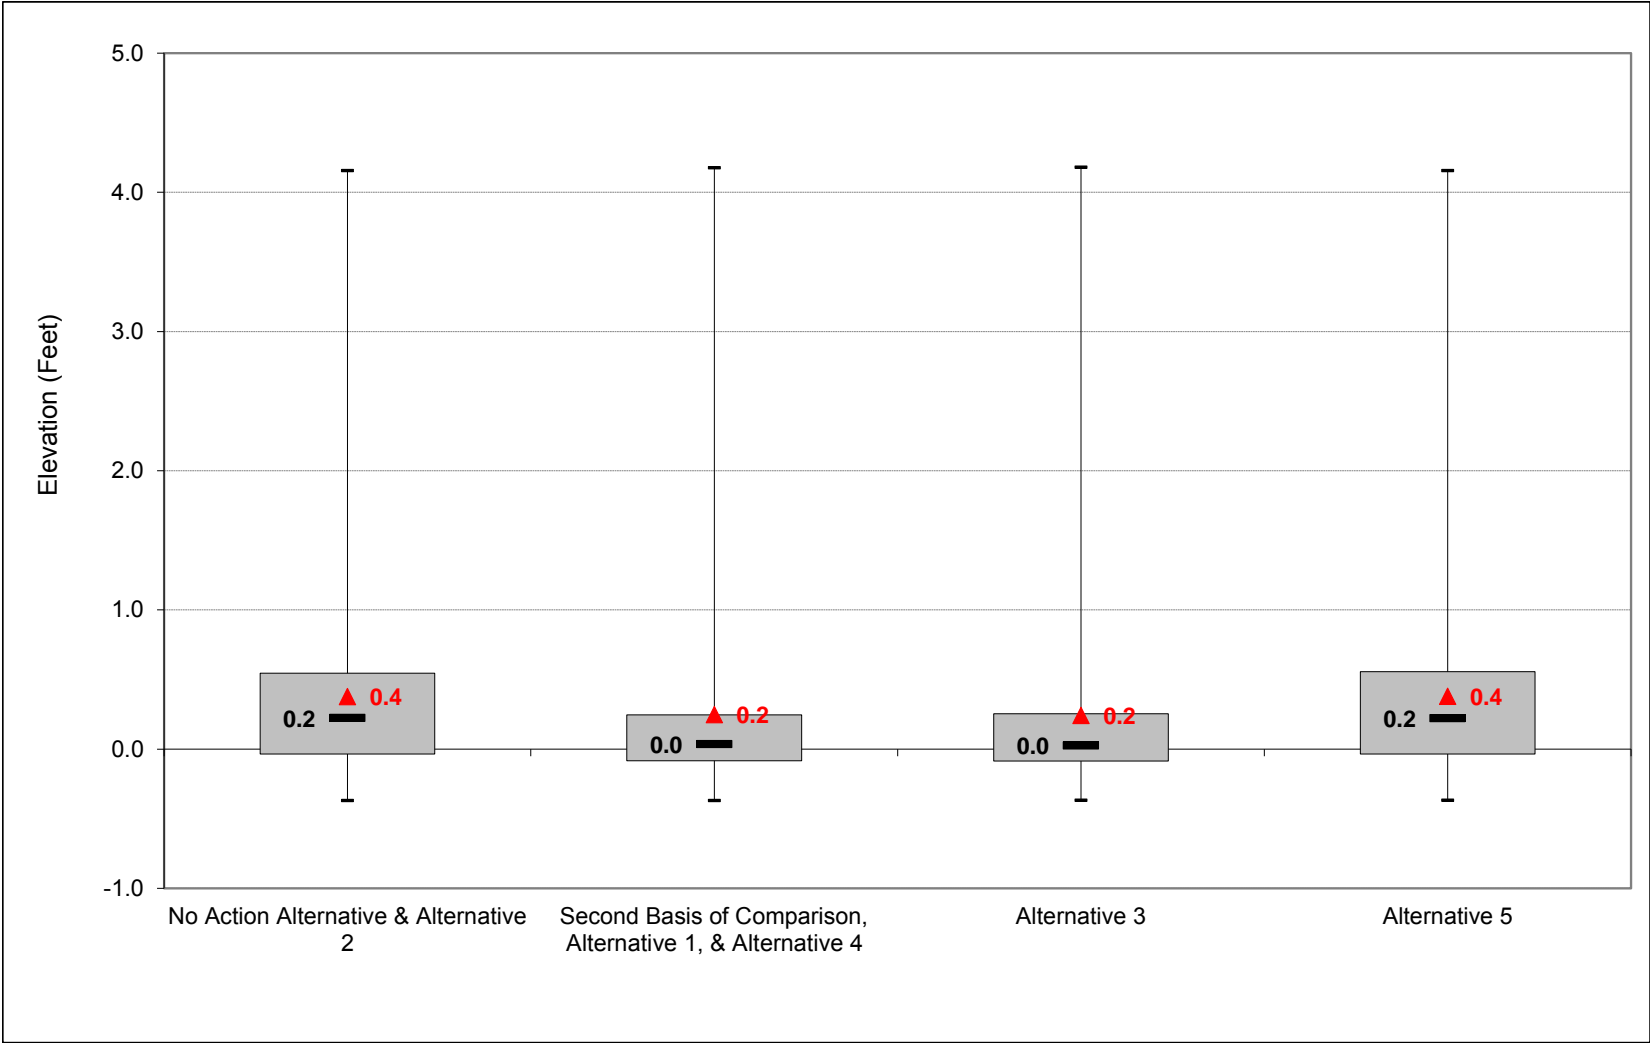


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-40-2-3. Steamboat Sl d/s of Sutter Sl, Monthly Averaged Daily Minimum Elevation, December

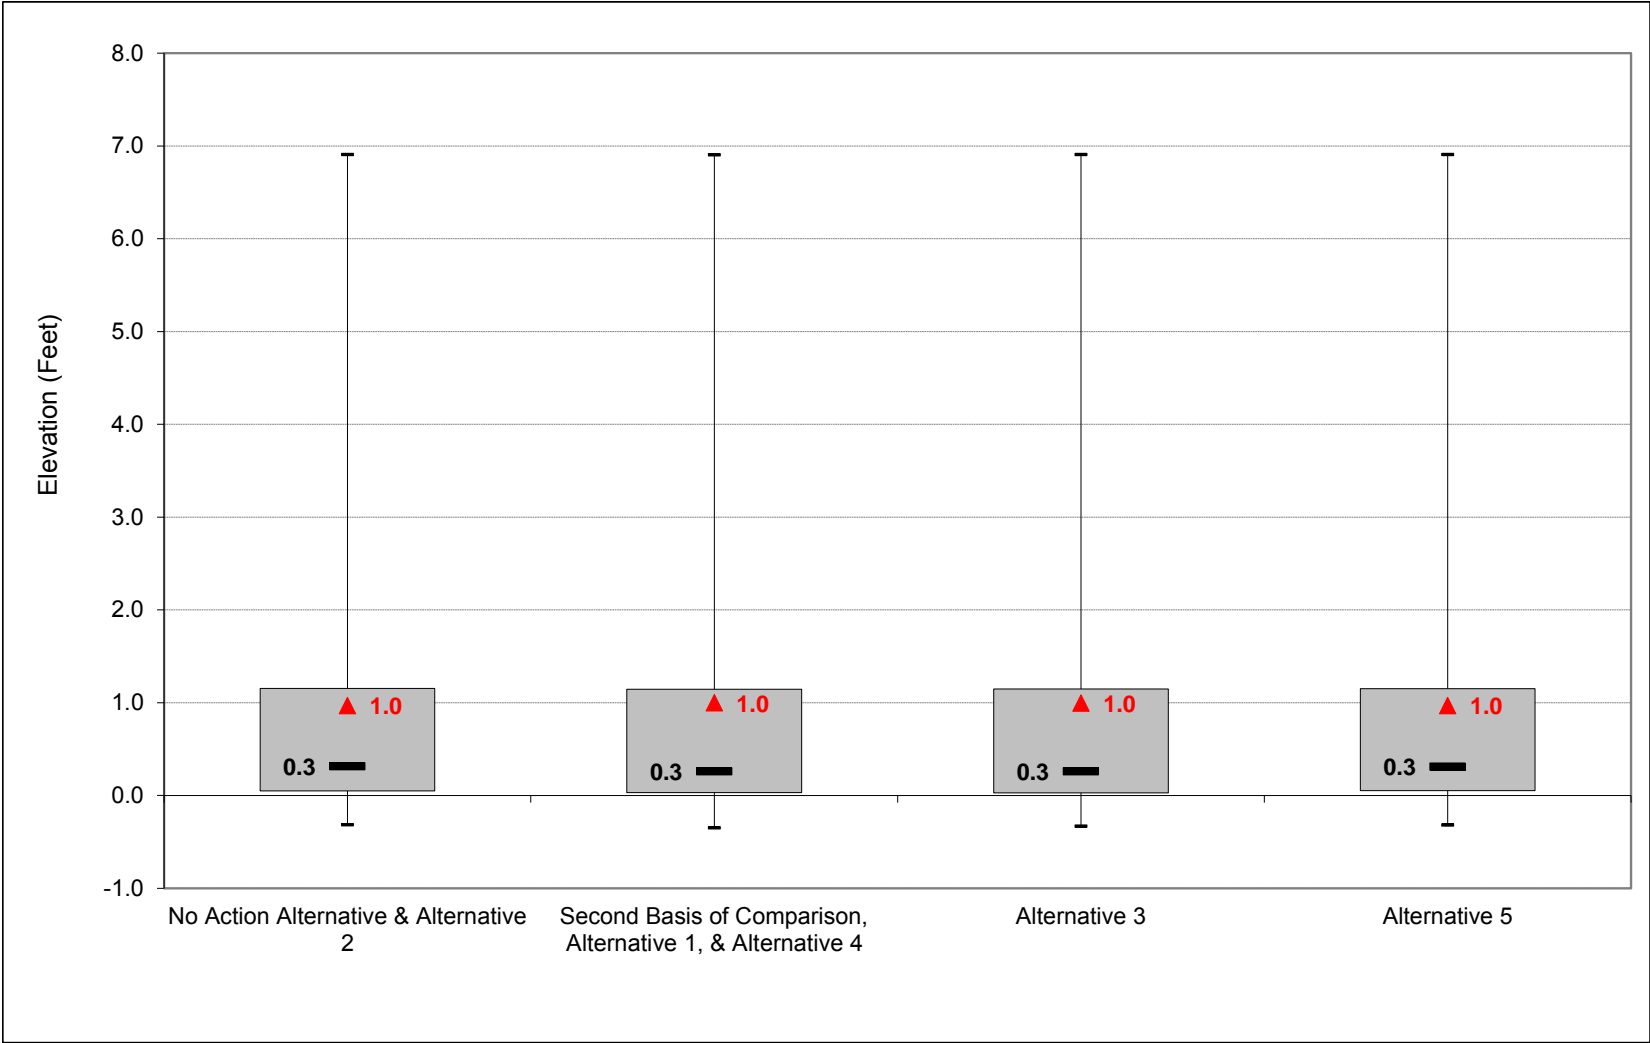


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-40-2-4. Steamboat SI d/s of Sutter SI, Monthly Averaged Daily Minimum Elevation, January

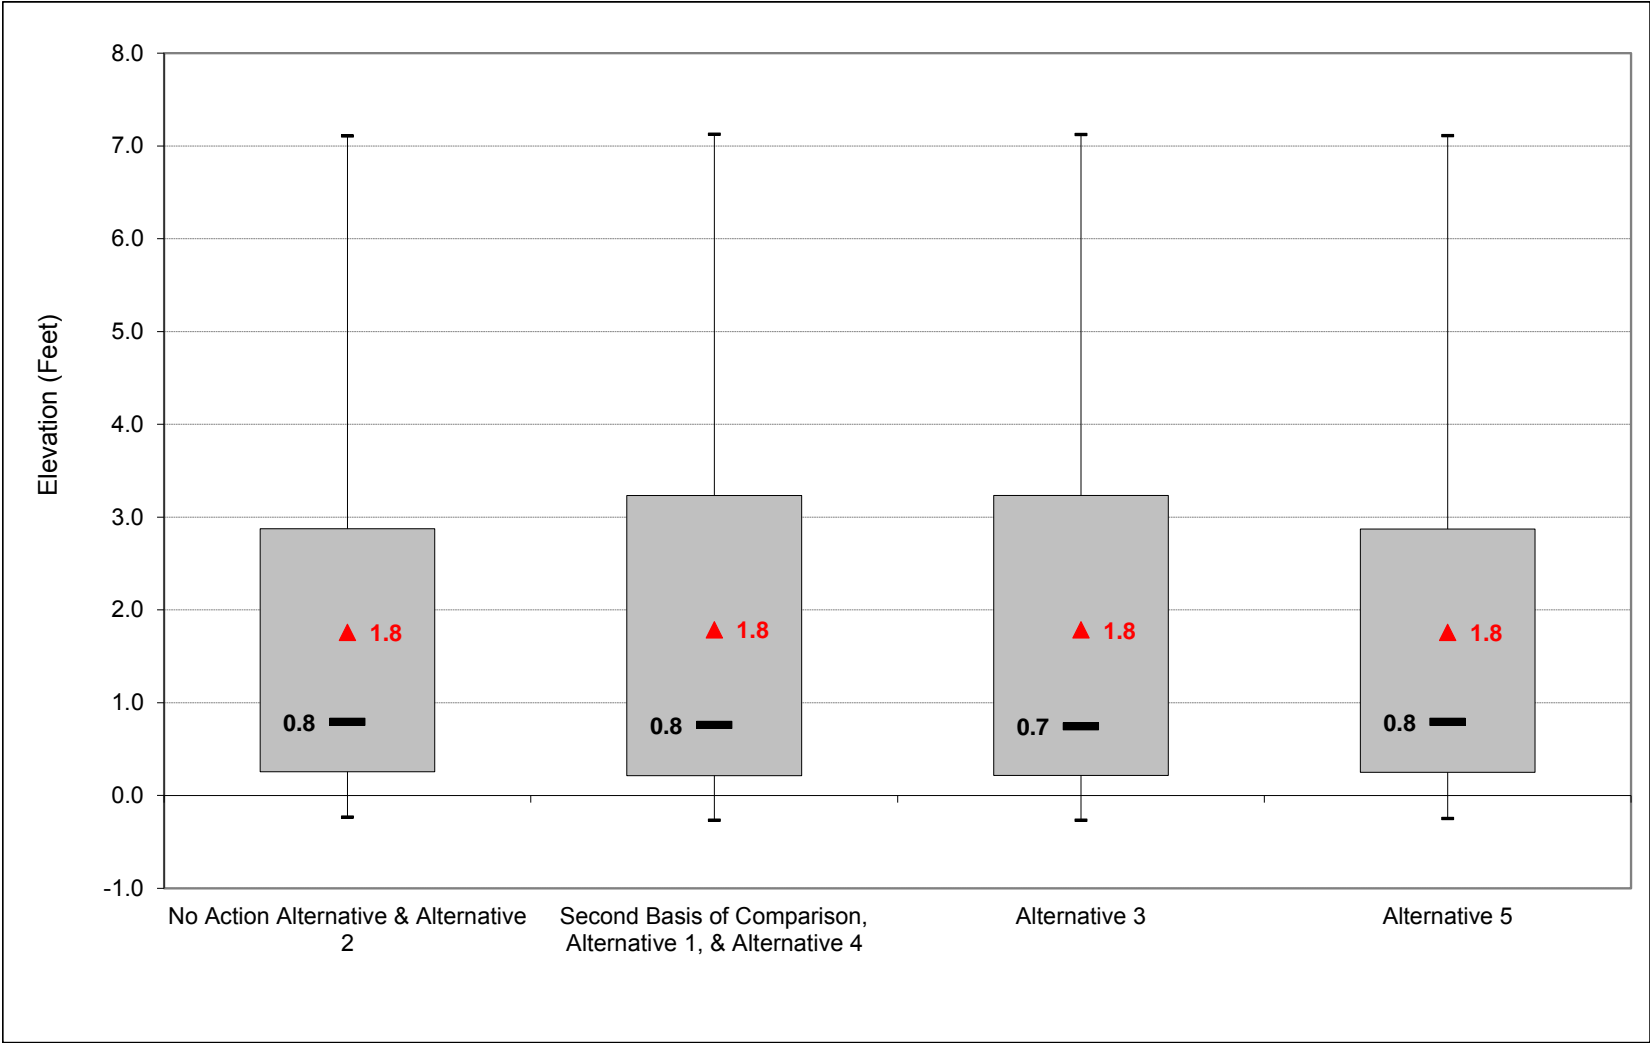


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-40-2-5. Steamboat SI d/s of Sutter SI, Monthly Averaged Daily Minimum Elevation, February

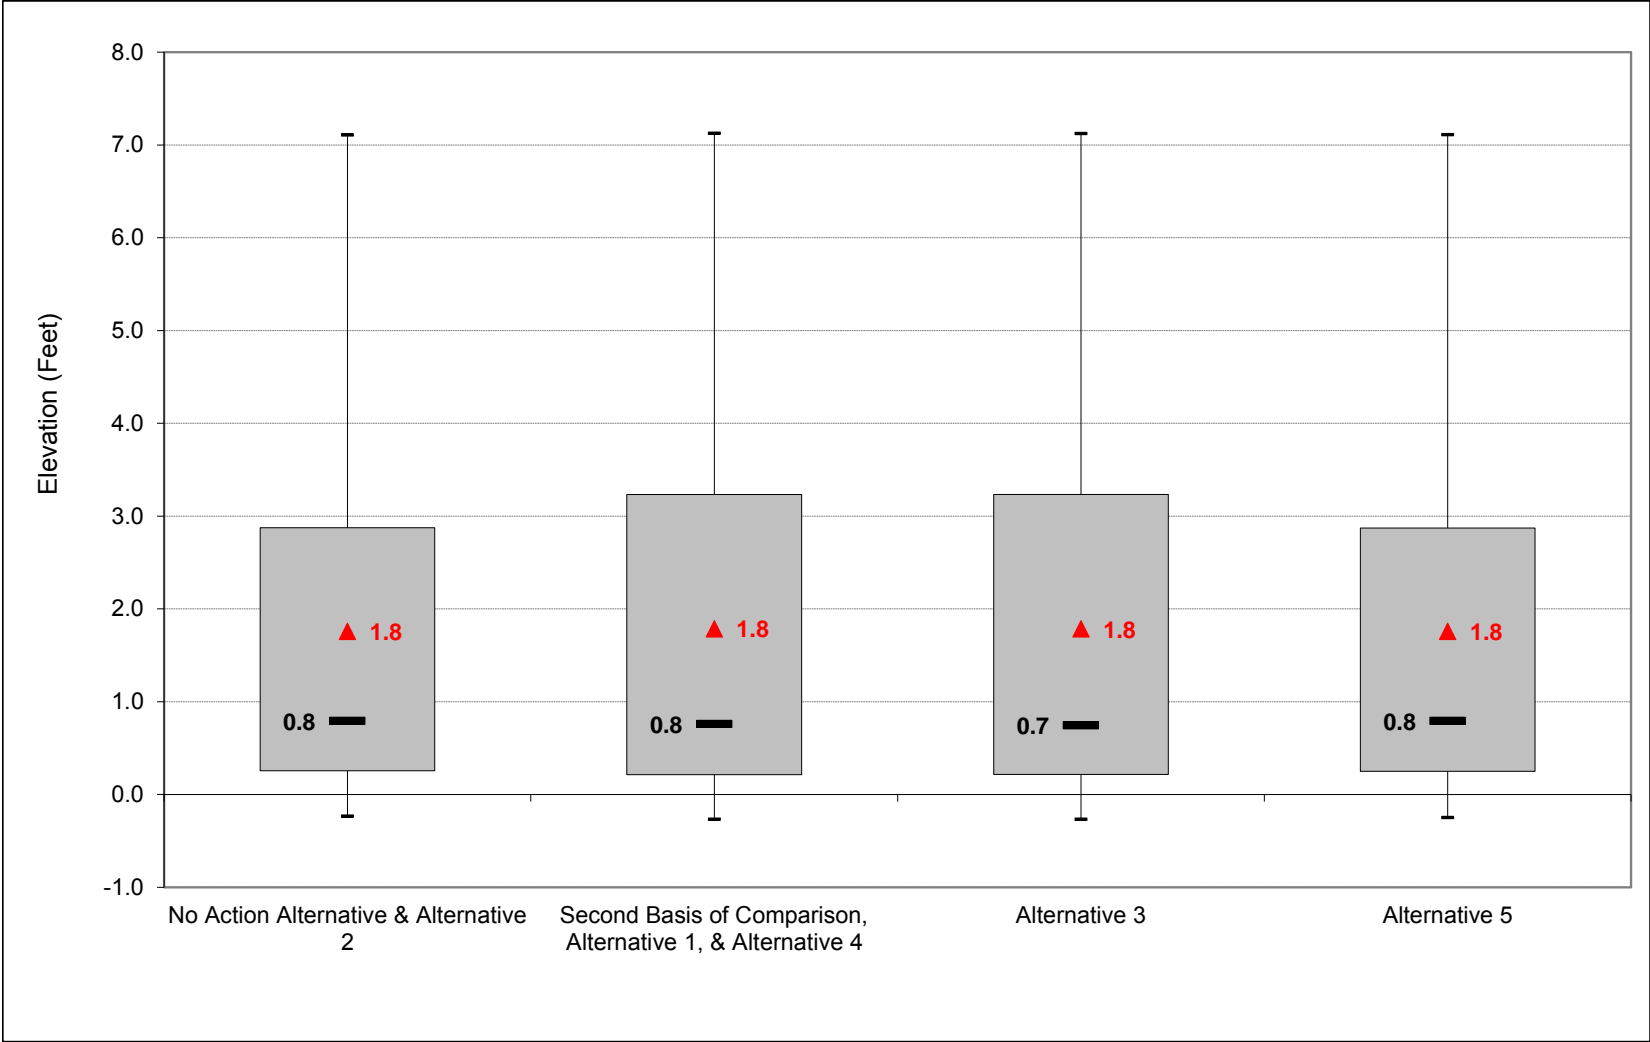


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-40-2-6. Steamboat Sl d/s of Sutter Sl, Monthly Averaged Daily Minimum Elevation, March

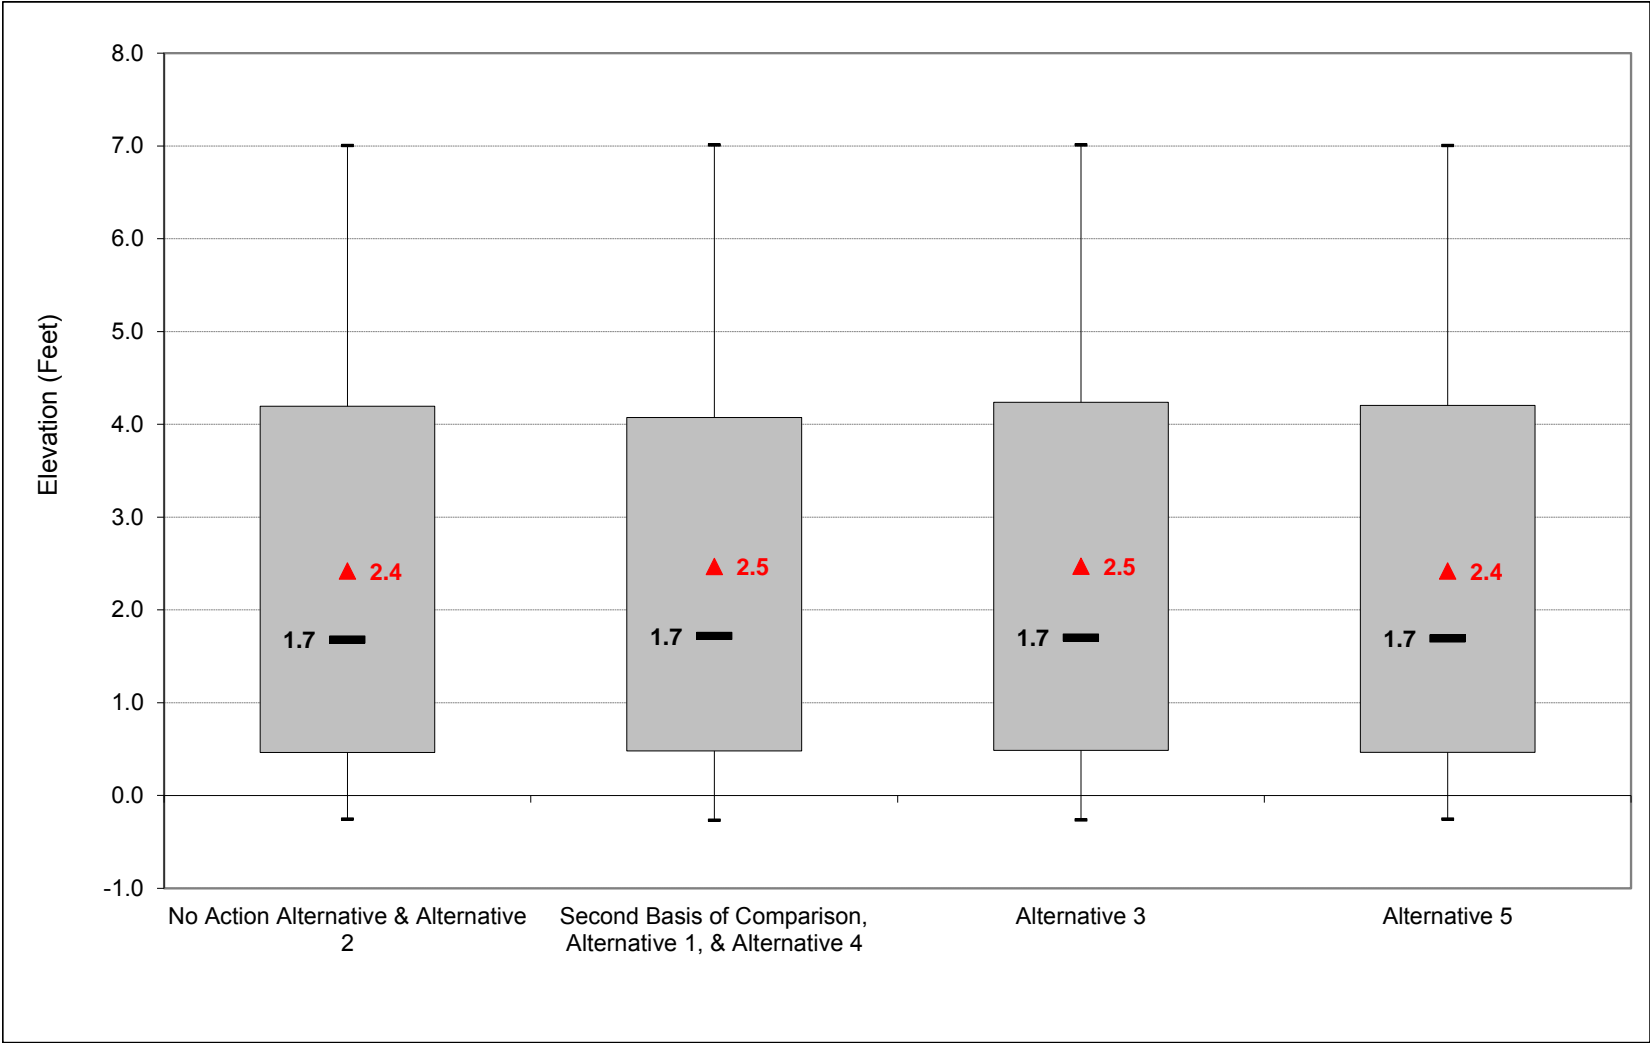


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-40-2-7. Steamboat Sl d/s of Sutter Sl, Monthly Averaged Daily Minimum Elevation, April

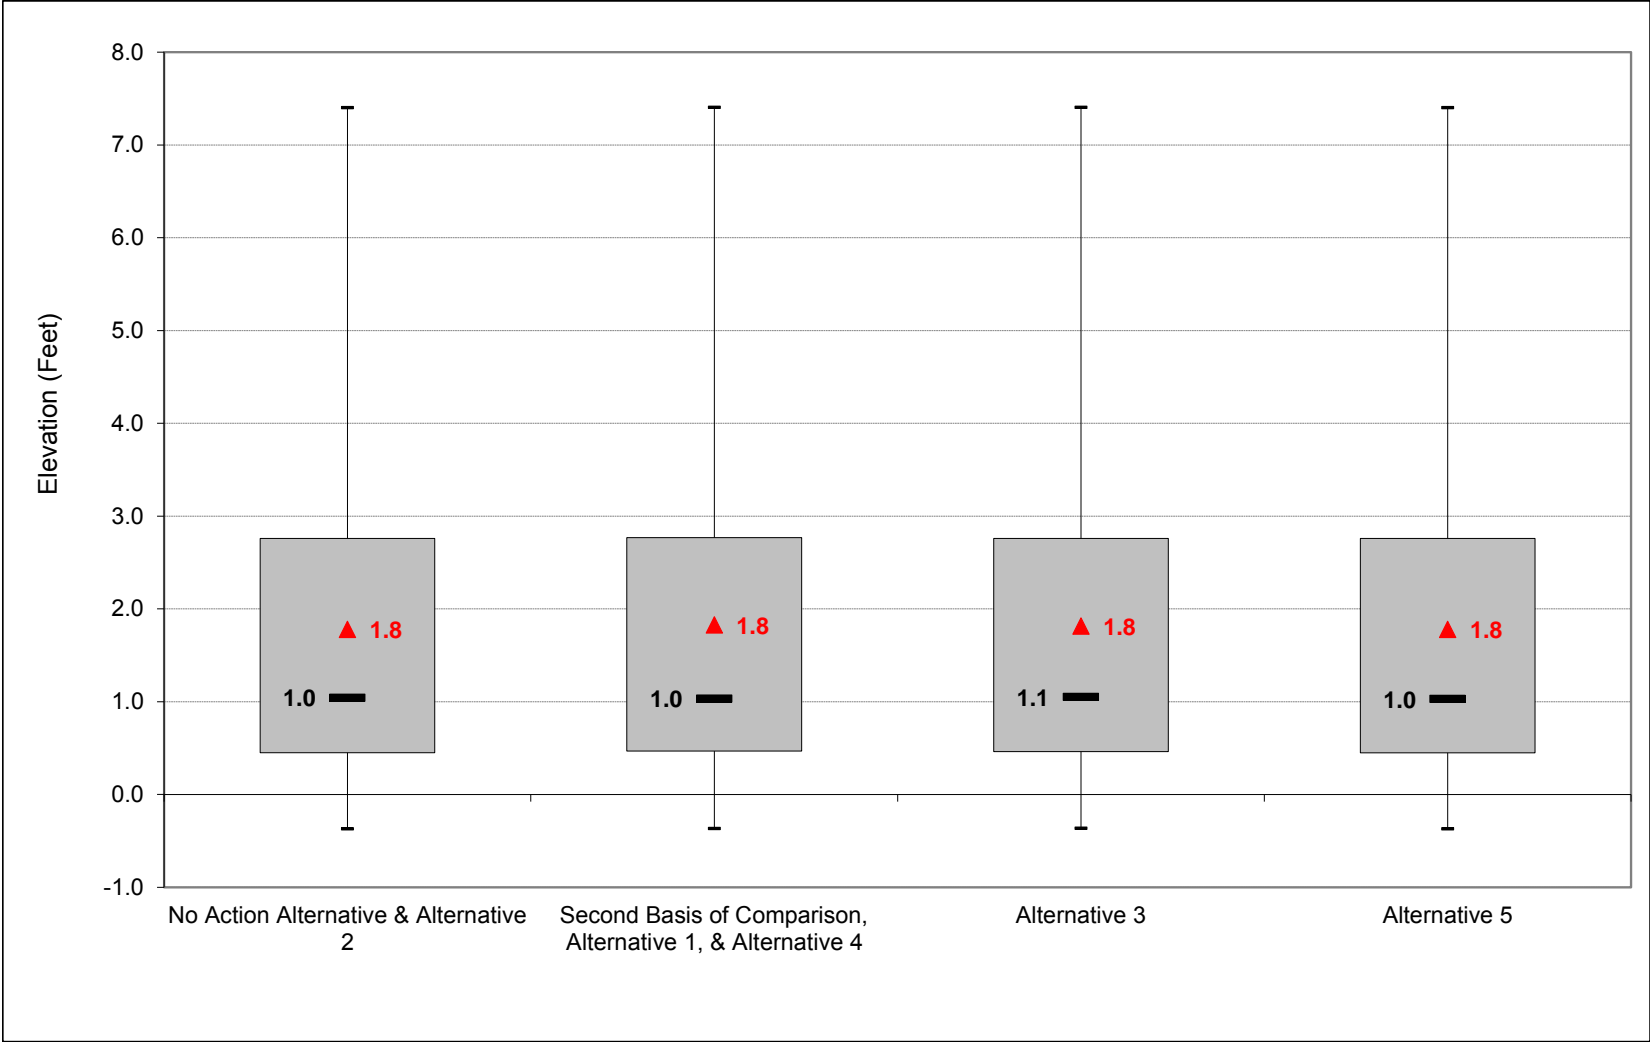


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-40-2-8. Steamboat Sl d/s of Sutter Sl, Monthly Averaged Daily Minimum Elevation, May

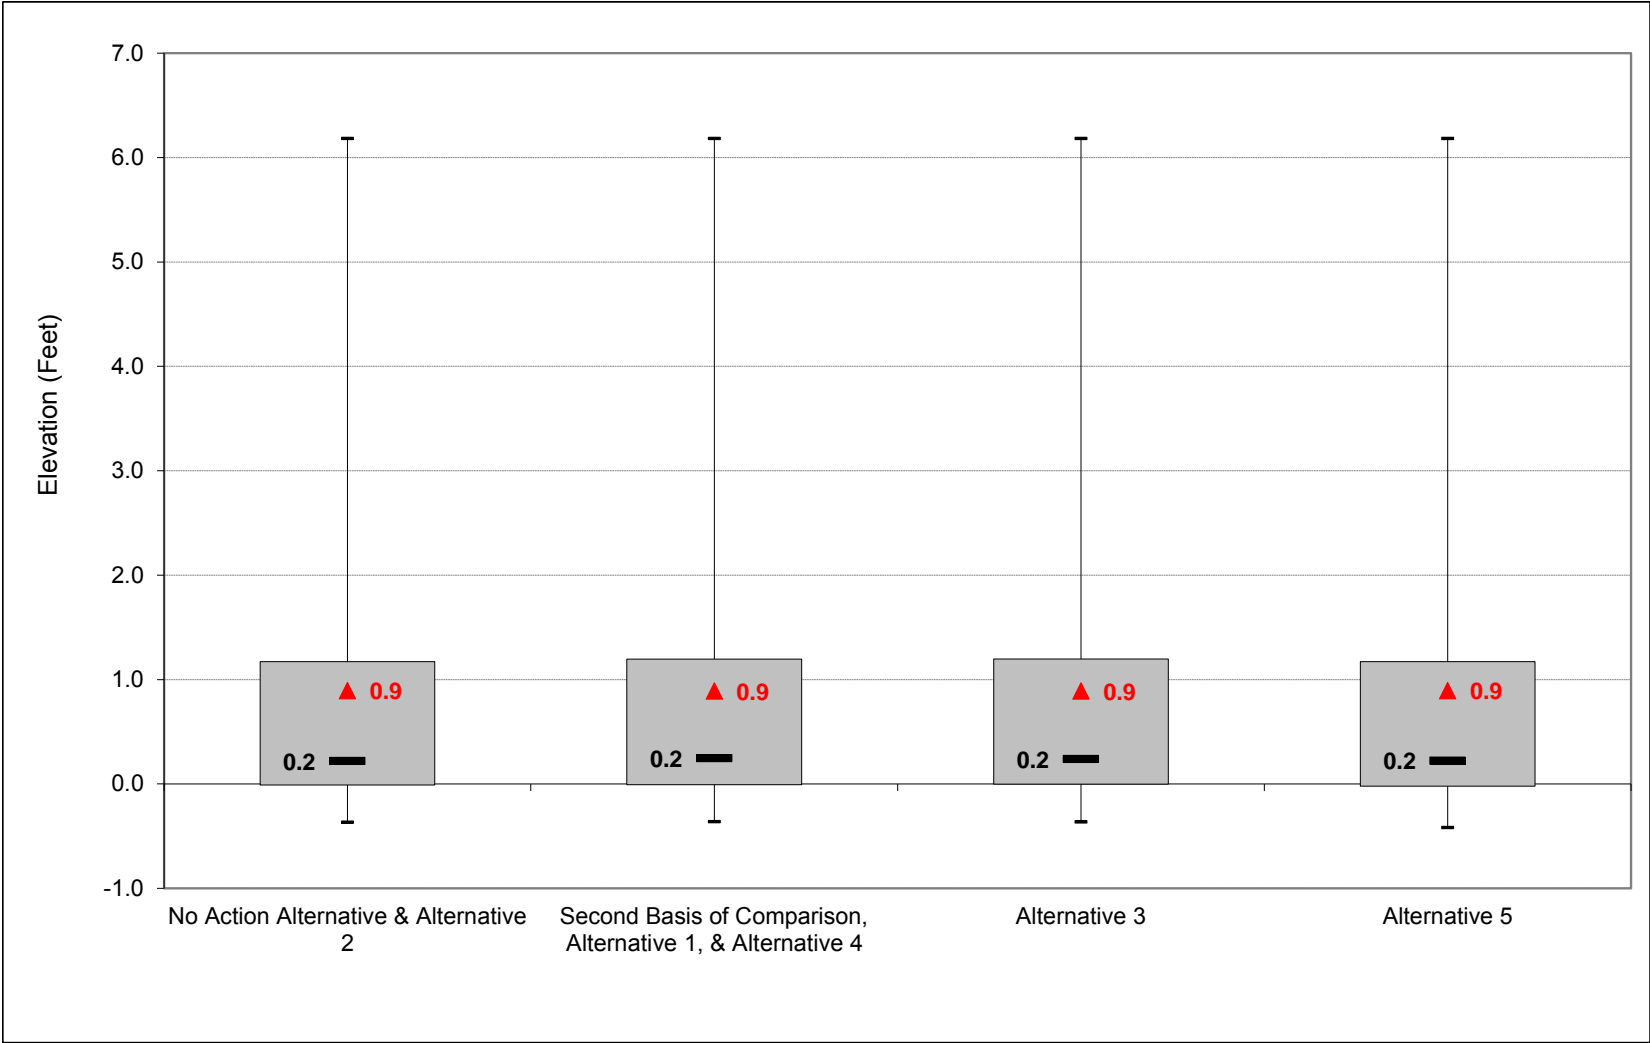


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-40-2-9. Steamboat SI d/s of Sutter SI, Monthly Averaged Daily Minimum Elevation, June

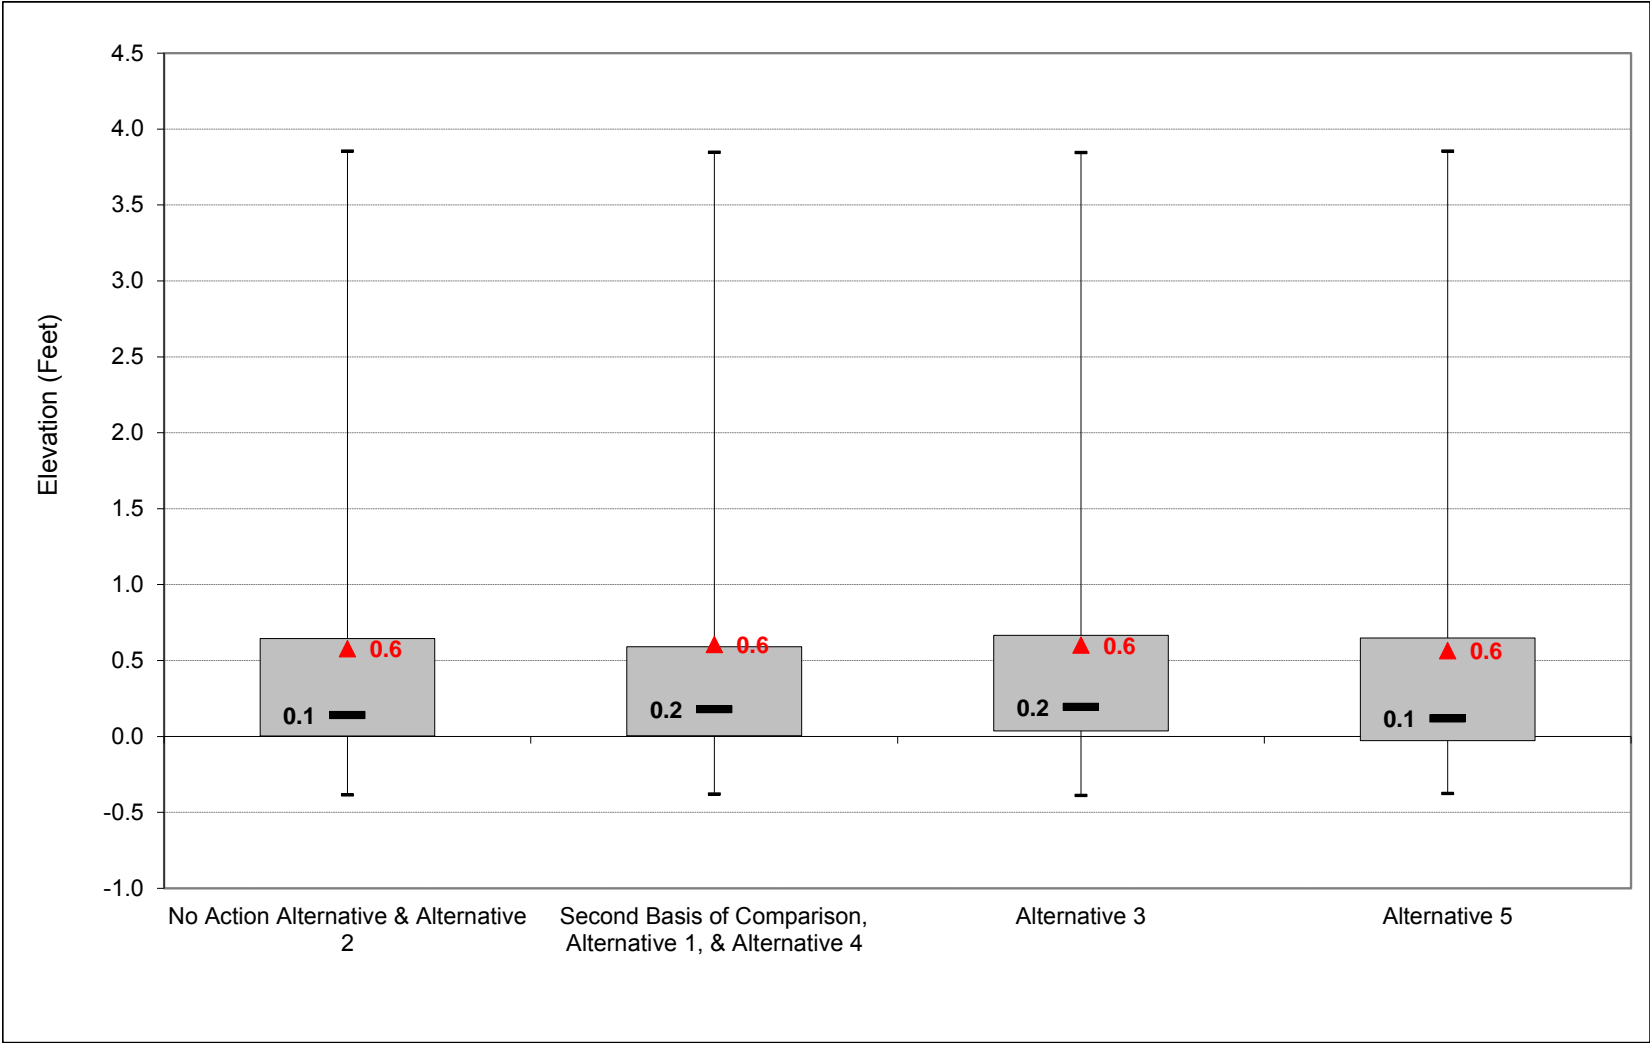


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-40-2-10. Steamboat SI d/s of Sutter SI, Monthly Averaged Daily Minimum Elevation, July

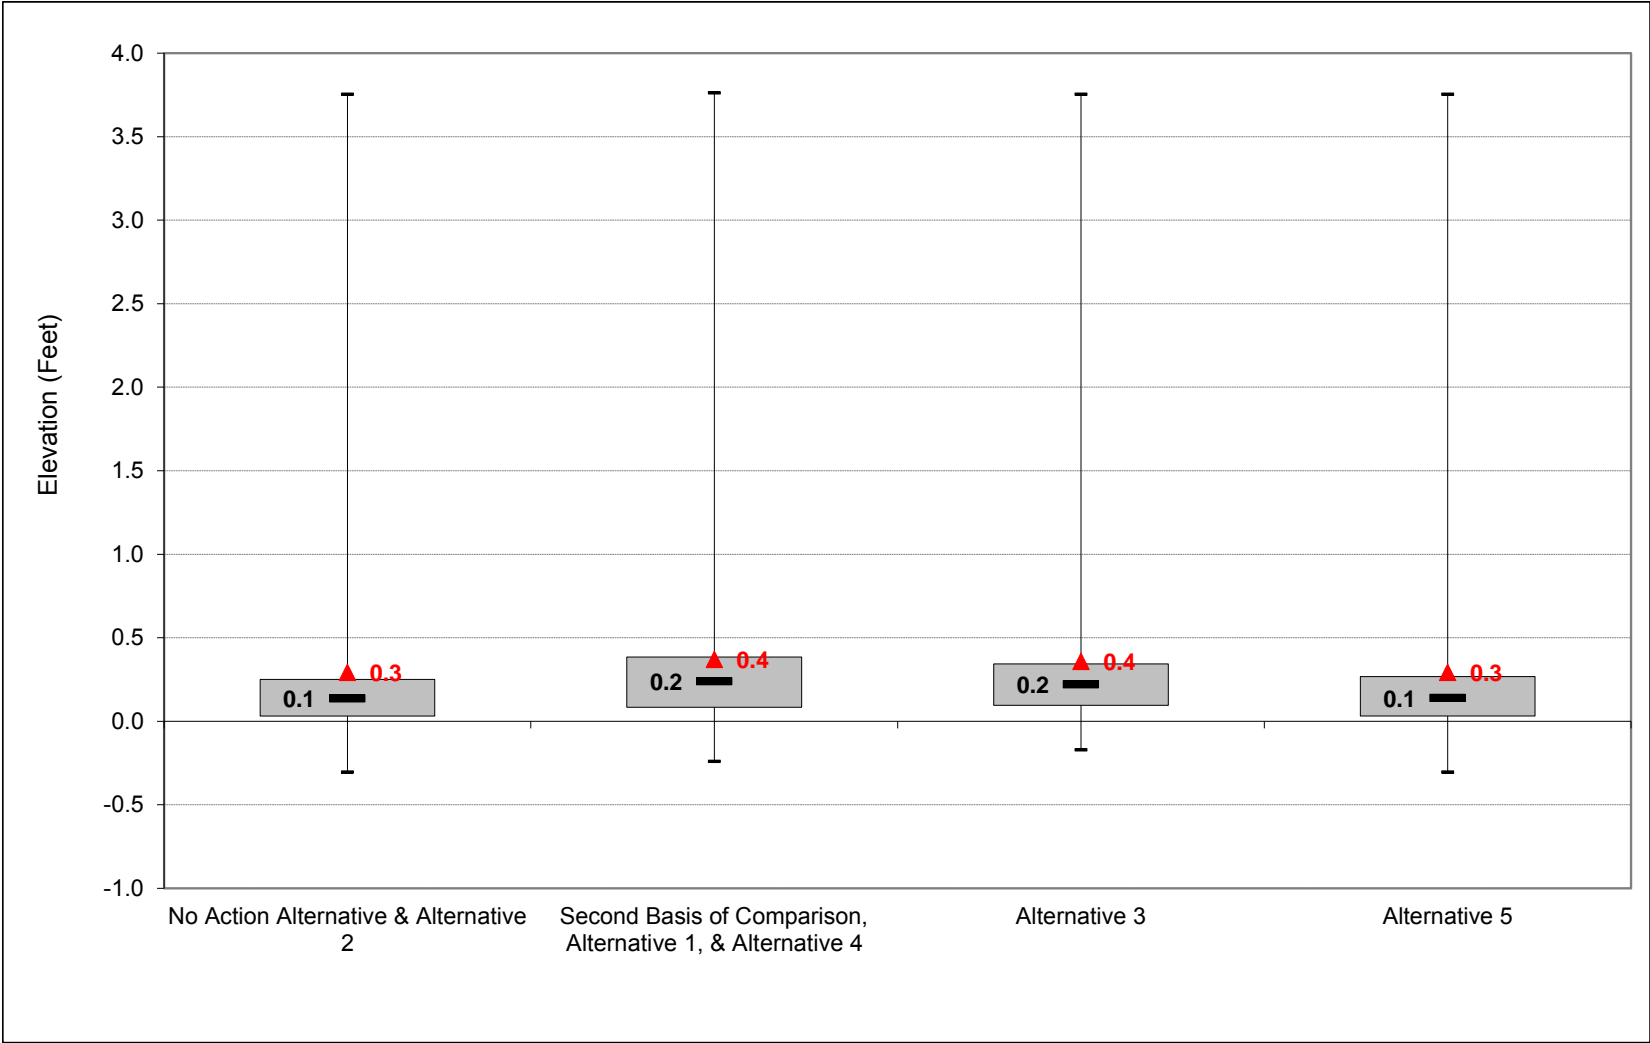


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-40-2-11. Steamboat SI d/s of Sutter SI, Monthly Averaged Daily Minimum Elevation, August

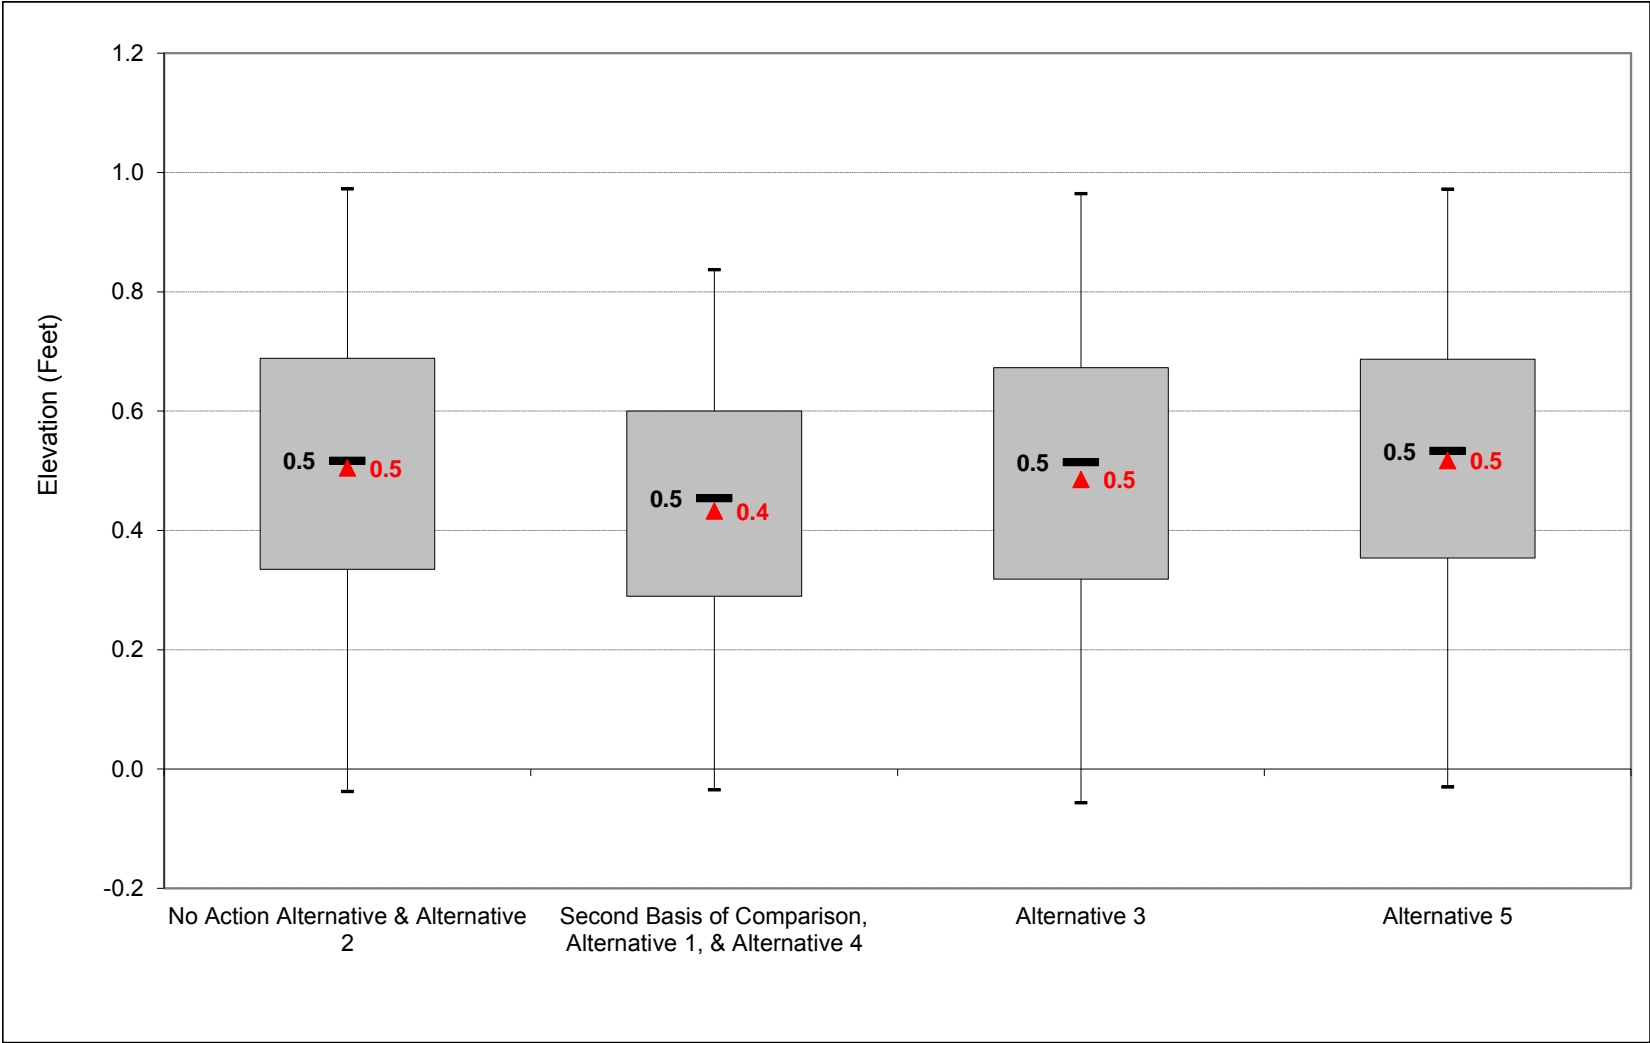

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-40-2-12. Steamboat SI d/s of Sutter SI, Monthly Averaged Daily Minimum Elevation, September

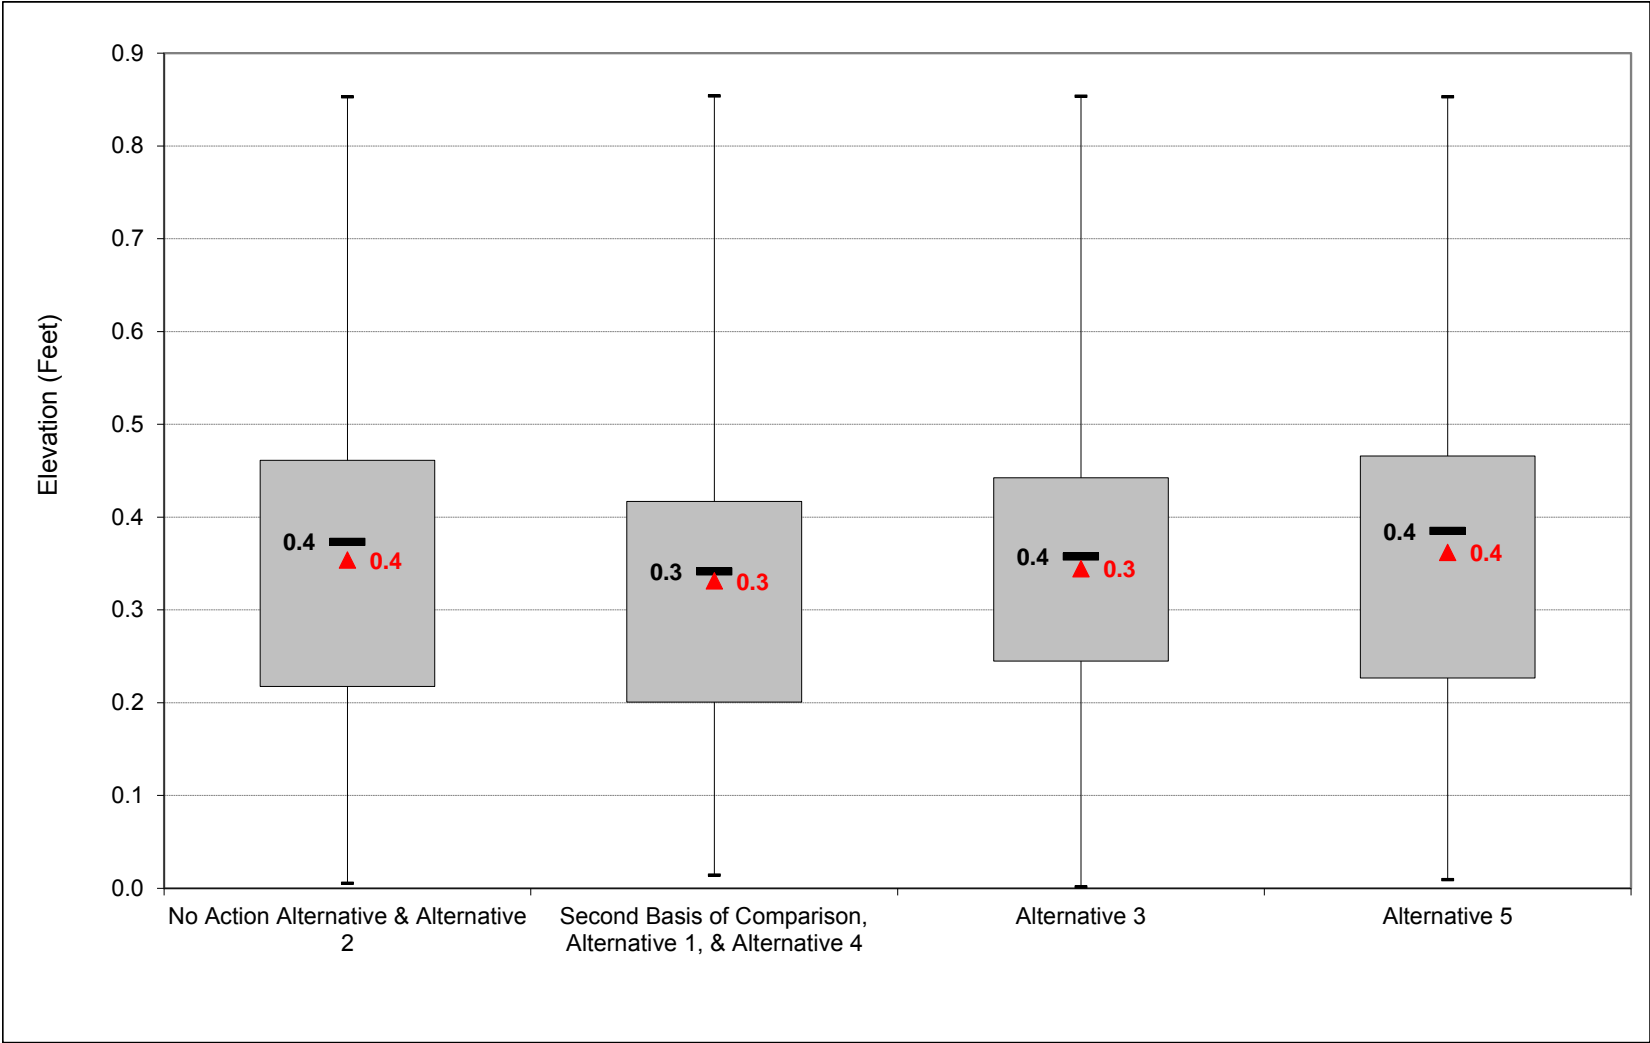

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-40-2-1. Steamboat SI d/s of Sutter SI, Monthly Averaged Daily Minimum Elevation

No Action Alternative												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.4	0.9	3.4	5.0	5.9	5.0	3.3	2.2	0.6	0.8	0.5	1.5
20%	0.3	0.6	1.6	3.7	4.8	3.6	1.8	1.0	0.3	0.7	0.5	1.4
30%	0.3	0.5	0.8	2.3	3.5	2.0	0.9	0.4	0.2	0.7	0.4	0.9
40%	0.2	0.4	0.5	1.2	2.7	1.4	0.5	0.3	0.2	0.6	0.4	0.7
50%	0.1	0.2	0.3	0.8	1.7	1.0	0.2	0.1	0.1	0.5	0.4	0.5
60%	0.1	0.1	0.2	0.5	1.0	0.7	0.1	0.1	0.1	0.5	0.3	0.3
70%	0.0	0.0	0.1	0.3	0.7	0.5	0.0	0.0	0.1	0.4	0.3	0.3
80%	0.0	-0.1	0.0	0.2	0.4	0.3	0.0	0.0	0.0	0.3	0.2	0.2
90%	-0.1	-0.2	-0.1	0.1	0.3	0.0	-0.1	-0.1	-0.1	0.2	0.1	0.1
Long Term												
Full Simulation Period ^b	0.2	0.4	1.0	1.8	2.4	1.8	0.9	0.6	0.3	0.5	0.4	0.7
Water Year Types ^c												
Wet (32%)	0.3	0.8	2.2	3.6	4.3	3.4	2.1	1.5	0.7	0.6	0.5	1.4
Above Normal (16%)	0.1	0.5	1.1	2.4	3.3	2.6	1.0	0.5	0.2	0.7	0.5	0.7
Below Normal (13%)	0.2	0.3	0.4	0.6	1.7	0.5	0.2	0.1	0.1	0.6	0.4	0.4
Dry (24%)	0.1	0.1	0.1	0.5	1.0	0.8	0.2	0.1	0.1	0.4	0.2	0.2
Critical (15%)	0.0	-0.1	0.1	0.3	0.4	0.2	0.0	-0.1	0.0	0.2	0.2	0.2

Alternative 1												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.4	0.8	3.9	5.1	5.9	5.0	3.3	2.1	0.6	0.7	0.5	0.6
20%	0.2	0.3	1.9	4.1	4.8	3.6	1.8	1.2	0.4	0.6	0.4	0.5
30%	0.2	0.2	0.8	2.5	3.6	2.6	0.8	0.5	0.3	0.6	0.4	0.4
40%	0.1	0.1	0.4	1.2	3.0	1.5	0.5	0.3	0.3	0.5	0.4	0.4
50%	0.1	0.0	0.3	0.8	1.7	1.0	0.2	0.2	0.2	0.5	0.3	0.3
60%	0.1	0.0	0.1	0.4	1.0	0.7	0.1	0.1	0.2	0.4	0.3	0.3
70%	0.0	-0.1	0.1	0.2	0.6	0.6	0.0	0.0	0.1	0.3	0.3	0.2
80%	0.0	-0.1	0.0	0.2	0.4	0.3	0.0	0.0	0.1	0.2	0.2	0.2
90%	-0.1	-0.2	-0.1	0.1	0.2	0.0	-0.1	-0.1	0.0	0.1	0.1	0.1
Long Term												
Full Simulation Period ^b	0.1	0.2	1.0	1.8	2.5	1.8	0.9	0.6	0.4	0.4	0.3	0.3
Water Year Types ^c												
Wet (32%)	0.3	0.6	2.4	3.7	4.3	3.4	2.0	1.5	0.8	0.6	0.4	0.5
Above Normal (16%)	0.1	0.4	1.1	2.5	3.4	2.7	1.0	0.5	0.3	0.6	0.4	0.4
Below Normal (13%)	0.1	0.2	0.3	0.6	1.8	0.6	0.2	0.2	0.3	0.6	0.4	0.4
Dry (24%)	0.1	0.0	0.1	0.4	1.0	0.8	0.2	0.1	0.2	0.3	0.2	0.2
Critical (15%)	0.0	-0.1	0.0	0.2	0.4	0.2	0.0	-0.1	0.0	0.1	0.2	0.2

Alternative 1 minus No Action Alternative												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	-0.1	0.5	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	-1.0
20%	-0.1	-0.3	0.3	0.4	0.0	0.0	0.0	0.2	0.1	-0.1	0.0	-1.0
30%	-0.1	-0.3	0.0	0.3	0.1	0.5	0.0	0.0	0.1	-0.1	0.0	-0.5
40%	-0.1	-0.2	-0.1	0.0	0.3	0.0	0.0	0.0	0.1	-0.1	0.0	-0.3
50%	0.0	-0.2	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.0	-0.1
60%	0.0	-0.1	-0.1	0.0	0.1	0.0	0.0	0.1	0.1	-0.1	0.0	0.0
70%	0.0	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.0	0.0
90%	0.0	0.0	-0.1	0.0	-0.1	0.0	0.0	0.0	0.1	-0.1	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.0	-0.4
Water Year Types ^c												
Wet (32%)	-0.1	-0.2	0.2	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	-0.9
Above Normal (16%)	0.0	-0.2	-0.1	0.1	0.1	0.2	0.0	0.1	0.1	-0.1	0.0	-0.3
Below Normal (13%)	0.0	-0.1	0.0	0.0	0.1	0.1	0.0	0.1	0.2	-0.1	-0.1	0.0
Dry (24%)	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-40-2.2. Steamboat SI d/s of Sutter SI, Monthly Averaged Daily Minimum Elevation

No Action Alternative												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.4	0.9	3.4	5.0	5.9	5.0	3.3	2.2	0.6	0.8	0.5	1.5
20%	0.3	0.6	1.6	3.7	4.8	3.6	1.8	1.0	0.3	0.7	0.5	1.4
30%	0.3	0.5	0.8	2.3	3.5	2.0	0.9	0.4	0.2	0.7	0.4	0.9
40%	0.2	0.4	0.5	1.2	2.7	1.4	0.5	0.3	0.2	0.6	0.4	0.7
50%	0.1	0.2	0.3	0.8	1.7	1.0	0.2	0.1	0.1	0.5	0.4	0.5
60%	0.1	0.1	0.2	0.5	1.0	0.7	0.1	0.1	0.1	0.5	0.3	0.3
70%	0.0	0.0	0.1	0.3	0.7	0.5	0.0	0.0	0.1	0.4	0.3	0.3
80%	0.0	-0.1	0.0	0.2	0.4	0.3	0.0	0.0	0.0	0.3	0.2	0.2
90%	-0.1	-0.2	-0.1	0.1	0.3	0.0	-0.1	-0.1	-0.1	0.2	0.1	0.1
Long Term												
Full Simulation Period ^b	0.2	0.4	1.0	1.8	2.4	1.8	0.9	0.6	0.3	0.5	0.4	0.7
Water Year Types ^c												
Wet (32%)	0.3	0.8	2.2	3.6	4.3	3.4	2.1	1.5	0.7	0.6	0.5	1.4
Above Normal (16%)	0.1	0.5	1.1	2.4	3.3	2.6	1.0	0.5	0.2	0.7	0.5	0.7
Below Normal (13%)	0.2	0.3	0.4	0.6	1.7	0.5	0.2	0.1	0.1	0.6	0.4	0.4
Dry (24%)	0.1	0.1	0.1	0.5	1.0	0.8	0.2	0.1	0.1	0.4	0.2	0.2
Critical (15%)	0.0	-0.1	0.1	0.3	0.4	0.2	0.0	-0.1	0.0	0.2	0.2	0.2

Alternative 3												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.4	0.8	3.9	5.1	5.9	5.0	3.2	2.1	0.6	0.7	0.5	0.6
20%	0.2	0.3	2.0	4.0	4.8	3.6	1.8	1.1	0.4	0.7	0.5	0.5
30%	0.2	0.2	0.8	2.5	3.6	2.3	0.8	0.5	0.3	0.7	0.4	0.4
40%	0.1	0.1	0.4	1.2	3.0	1.5	0.5	0.3	0.3	0.6	0.4	0.4
50%	0.1	0.0	0.3	0.7	1.7	1.1	0.2	0.2	0.2	0.5	0.4	0.3
60%	0.1	0.0	0.1	0.4	1.0	0.7	0.1	0.1	0.2	0.5	0.3	0.3
70%	0.0	-0.1	0.0	0.3	0.7	0.6	0.0	0.0	0.1	0.4	0.3	0.2
80%	0.0	-0.1	0.0	0.2	0.4	0.3	0.0	0.0	0.1	0.2	0.2	0.2
90%	-0.1	-0.2	-0.1	0.0	0.3	0.0	-0.1	-0.1	0.0	0.1	0.1	0.1
Long Term												
Full Simulation Period ^b	0.1	0.2	1.0	1.8	2.5	1.8	0.9	0.6	0.4	0.5	0.3	0.3
Water Year Types ^c												
Wet (32%)	0.2	0.6	2.4	3.7	4.3	3.4	2.0	1.5	0.8	0.6	0.4	0.5
Above Normal (16%)	0.1	0.4	1.1	2.4	3.4	2.7	1.0	0.5	0.3	0.6	0.4	0.4
Below Normal (13%)	0.1	0.2	0.3	0.6	1.8	0.6	0.2	0.2	0.2	0.7	0.4	0.4
Dry (24%)	0.1	0.0	0.1	0.4	1.0	0.8	0.2	0.1	0.2	0.3	0.2	0.2
Critical (15%)	0.0	-0.1	0.0	0.2	0.4	0.2	0.0	-0.1	0.0	0.1	0.2	0.2

Alternative 3 minus No Action Alternative												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.1	-0.1	0.4	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-1.0
20%	-0.1	-0.3	0.4	0.4	0.0	0.0	0.0	0.1	0.1	0.0	0.0	-1.0
30%	-0.1	-0.3	0.0	0.3	0.1	0.3	0.0	0.1	0.1	0.0	0.0	-0.5
40%	-0.1	-0.3	-0.1	0.0	0.3	0.0	0.0	0.0	0.1	0.0	0.0	-0.3
50%	0.0	-0.2	-0.1	-0.1	0.0	0.0	0.0	0.1	0.1	0.0	0.0	-0.1
60%	0.0	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0
70%	0.0	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0
80%	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0
90%	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	-0.1	0.0	0.0	0.1	0.0	0.0	0.0	0.1	0.0	0.0	-0.3
Water Year Types ^c												
Wet (32%)	-0.1	-0.2	0.2	0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-1.0
Above Normal (16%)	0.0	-0.2	-0.1	0.0	0.1	0.1	0.0	0.0	0.1	0.0	0.0	-0.3
Below Normal (13%)	-0.1	-0.2	0.0	0.0	0.1	0.1	0.0	0.1	0.1	0.0	0.0	0.0
Dry (24%)	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-40-2.3. Steamboat SI d/s of Sutter SI, Monthly Averaged Daily Minimum Elevation

No Action Alternative												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.4	0.9	3.4	5.0	5.9	5.0	3.3	2.2	0.6	0.8	0.5	1.5
20%	0.3	0.6	1.6	3.7	4.8	3.6	1.8	1.0	0.3	0.7	0.5	1.4
30%	0.3	0.5	0.8	2.3	3.5	2.0	0.9	0.4	0.2	0.7	0.4	0.9
40%	0.2	0.4	0.5	1.2	2.7	1.4	0.5	0.3	0.2	0.6	0.4	0.7
50%	0.1	0.2	0.3	0.8	1.7	1.0	0.2	0.1	0.1	0.5	0.4	0.5
60%	0.1	0.1	0.2	0.5	1.0	0.7	0.1	0.1	0.1	0.5	0.3	0.3
70%	0.0	0.0	0.1	0.3	0.7	0.5	0.0	0.0	0.1	0.4	0.3	0.3
80%	0.0	-0.1	0.0	0.2	0.4	0.3	0.0	0.0	0.0	0.3	0.2	0.2
90%	-0.1	-0.2	-0.1	0.1	0.3	0.0	-0.1	-0.1	-0.1	0.2	0.1	0.1
Long Term												
Full Simulation Period ^b	0.2	0.4	1.0	1.8	2.4	1.8	0.9	0.6	0.3	0.5	0.4	0.7
Water Year Types ^c												
Wet (32%)	0.3	0.8	2.2	3.6	4.3	3.4	2.1	1.5	0.7	0.6	0.5	1.4
Above Normal (16%)	0.1	0.5	1.1	2.4	3.3	2.6	1.0	0.5	0.2	0.7	0.5	0.7
Below Normal (13%)	0.2	0.3	0.4	0.6	1.7	0.5	0.2	0.1	0.1	0.6	0.4	0.4
Dry (24%)	0.1	0.1	0.1	0.5	1.0	0.8	0.2	0.1	0.1	0.4	0.2	0.2
Critical (15%)	0.0	-0.1	0.1	0.3	0.4	0.2	0.0	-0.1	0.0	0.2	0.2	0.2

Alternative 5												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.4	0.9	3.4	5.0	5.9	5.0	3.3	2.2	0.6	0.8	0.5	1.5
20%	0.3	0.6	1.6	3.7	4.8	3.6	1.8	1.0	0.3	0.7	0.5	1.4
30%	0.2	0.5	0.8	2.3	3.5	2.0	0.9	0.4	0.2	0.7	0.4	0.9
40%	0.2	0.4	0.5	1.2	2.7	1.4	0.5	0.2	0.2	0.6	0.4	0.7
50%	0.1	0.2	0.3	0.8	1.7	1.0	0.2	0.1	0.1	0.5	0.4	0.5
60%	0.1	0.1	0.2	0.5	1.0	0.7	0.1	0.0	0.1	0.5	0.3	0.3
70%	0.0	0.0	0.1	0.3	0.7	0.5	0.0	0.0	0.1	0.4	0.3	0.3
80%	0.0	-0.1	0.0	0.2	0.4	0.3	0.0	-0.1	0.0	0.3	0.2	0.2
90%	-0.1	-0.2	-0.1	0.1	0.3	0.0	-0.1	-0.2	-0.1	0.2	0.1	0.1
Long Term												
Full Simulation Period ^b	0.2	0.4	1.0	1.8	2.4	1.8	0.9	0.6	0.3	0.5	0.4	0.7
Water Year Types ^c												
Wet (32%)	0.3	0.8	2.2	3.6	4.3	3.4	2.1	1.5	0.7	0.7	0.5	1.4
Above Normal (16%)	0.1	0.5	1.1	2.4	3.3	2.6	1.0	0.5	0.2	0.7	0.5	0.7
Below Normal (13%)	0.2	0.3	0.4	0.6	1.7	0.5	0.2	0.1	0.1	0.6	0.4	0.4
Dry (24%)	0.1	0.1	0.1	0.5	1.0	0.8	0.2	0.0	0.1	0.4	0.2	0.2
Critical (15%)	0.0	-0.1	0.1	0.3	0.4	0.2	-0.1	-0.1	0.0	0.2	0.2	0.2

Alternative 5 minus No Action Alternative												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
30%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-40-2-4. Steamboat SI d/s of Sutter SI, Monthly Averaged Daily Minimum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.4	0.8	3.9	5.1	5.9	5.0	3.3	2.1	0.6	0.7	0.5	0.6
20%	0.2	0.3	1.9	4.1	4.8	3.6	1.8	1.2	0.4	0.6	0.4	0.5
30%	0.2	0.2	0.8	2.5	3.6	2.6	0.8	0.5	0.3	0.6	0.4	0.4
40%	0.1	0.1	0.4	1.2	3.0	1.5	0.5	0.3	0.3	0.5	0.4	0.4
50%	0.1	0.0	0.3	0.8	1.7	1.0	0.2	0.2	0.2	0.5	0.3	0.3
60%	0.1	0.0	0.1	0.4	1.0	0.7	0.1	0.1	0.2	0.4	0.3	0.3
70%	0.0	-0.1	0.1	0.2	0.6	0.6	0.0	0.0	0.1	0.3	0.3	0.2
80%	0.0	-0.1	0.0	0.2	0.4	0.3	0.0	0.0	0.1	0.2	0.2	0.2
90%	-0.1	-0.2	-0.1	0.1	0.2	0.0	-0.1	-0.1	0.0	0.1	0.1	0.1
Long Term												
Full Simulation Period ^b	0.1	0.2	1.0	1.8	2.5	1.8	0.9	0.6	0.4	0.4	0.3	0.3
Water Year Types ^c												
Wet (32%)	0.3	0.6	2.4	3.7	4.3	3.4	2.0	1.5	0.8	0.6	0.4	0.5
Above Normal (16%)	0.1	0.4	1.1	2.5	3.4	2.7	1.0	0.5	0.3	0.6	0.4	0.4
Below Normal (13%)	0.1	0.2	0.3	0.6	1.8	0.6	0.2	0.2	0.3	0.6	0.4	0.4
Dry (24%)	0.1	0.0	0.1	0.4	1.0	0.8	0.2	0.1	0.2	0.3	0.2	0.2
Critical (15%)	0.0	-0.1	0.0	0.2	0.4	0.2	0.0	-0.1	0.0	0.1	0.2	0.2

No Action Alternative

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.4	0.9	3.4	5.0	5.9	5.0	3.3	2.2	0.6	0.8	0.5	1.5
20%	0.3	0.6	1.6	3.7	4.8	3.6	1.8	1.0	0.3	0.7	0.5	1.4
30%	0.3	0.5	0.8	2.3	3.5	2.0	0.9	0.4	0.2	0.7	0.4	0.9
40%	0.2	0.4	0.5	1.2	2.7	1.4	0.5	0.3	0.2	0.6	0.4	0.7
50%	0.1	0.2	0.3	0.8	1.7	1.0	0.2	0.1	0.1	0.5	0.4	0.5
60%	0.1	0.1	0.2	0.5	1.0	0.7	0.1	0.1	0.1	0.5	0.3	0.3
70%	0.0	0.0	0.1	0.3	0.7	0.5	0.0	0.0	0.1	0.4	0.3	0.3
80%	0.0	-0.1	0.0	0.2	0.4	0.3	0.0	0.0	0.0	0.3	0.2	0.2
90%	-0.1	-0.2	-0.1	0.1	0.3	0.0	-0.1	-0.1	-0.1	0.2	0.1	0.1
Long Term												
Full Simulation Period ^b	0.2	0.4	1.0	1.8	2.4	1.8	0.9	0.6	0.3	0.5	0.4	0.7
Water Year Types ^c												
Wet (32%)	0.3	0.8	2.2	3.6	4.3	3.4	2.1	1.5	0.7	0.6	0.5	1.4
Above Normal (16%)	0.1	0.5	1.1	2.4	3.3	2.6	1.0	0.5	0.2	0.7	0.5	0.7
Below Normal (13%)	0.2	0.3	0.4	0.6	1.7	0.5	0.2	0.1	0.1	0.6	0.4	0.4
Dry (24%)	0.1	0.1	0.1	0.5	1.0	0.8	0.2	0.1	0.1	0.4	0.2	0.2
Critical (15%)	0.0	-0.1	0.1	0.3	0.4	0.2	0.0	-0.1	0.0	0.2	0.2	0.2

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.1	-0.5	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	1.0
20%	0.1	0.3	-0.3	-0.4	0.0	0.0	0.0	-0.2	-0.1	0.1	0.0	1.0
30%	0.1	0.3	0.0	-0.3	-0.1	-0.5	0.0	0.0	-0.1	0.1	0.0	0.5
40%	0.1	0.2	0.1	0.0	-0.3	0.0	0.0	0.0	-0.1	0.1	0.0	0.3
50%	0.0	0.2	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.0	0.1
60%	0.0	0.1	0.1	0.0	-0.1	0.0	0.0	-0.1	-0.1	0.1	0.0	0.0
70%	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.0	0.0
90%	0.0	0.0	0.1	0.0	0.1	0.0	0.0	0.0	-0.1	0.1	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.0	0.4
Water Year Types ^c												
Wet (32%)	0.1	0.2	-0.2	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.9
Above Normal (16%)	0.0	0.2	0.1	-0.1	-0.1	-0.2	0.0	-0.1	-0.1	0.1	0.0	0.3
Below Normal (13%)	0.0	0.1	0.0	0.0	-0.1	-0.1	0.0	-0.1	-0.2	0.1	0.1	0.0
Dry (24%)	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-40-2.5. Steamboat SI d/s of Sutter SI, Monthly Averaged Daily Minimum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.4	0.8	3.9	5.1	5.9	5.0	3.3	2.1	0.6	0.7	0.5	0.6
20%	0.2	0.3	1.9	4.1	4.8	3.6	1.8	1.2	0.4	0.6	0.4	0.5
30%	0.2	0.2	0.8	2.5	3.6	2.6	0.8	0.5	0.3	0.6	0.4	0.4
40%	0.1	0.1	0.4	1.2	3.0	1.5	0.5	0.3	0.3	0.5	0.4	0.4
50%	0.1	0.0	0.3	0.8	1.7	1.0	0.2	0.2	0.2	0.5	0.3	0.3
60%	0.1	0.0	0.1	0.4	1.0	0.7	0.1	0.1	0.2	0.4	0.3	0.3
70%	0.0	-0.1	0.1	0.2	0.6	0.6	0.0	0.0	0.1	0.3	0.3	0.2
80%	0.0	-0.1	0.0	0.2	0.4	0.3	0.0	0.0	0.1	0.2	0.2	0.2
90%	-0.1	-0.2	-0.1	0.1	0.2	0.0	-0.1	-0.1	0.0	0.1	0.1	0.1
Long Term												
Full Simulation Period ^b	0.1	0.2	1.0	1.8	2.5	1.8	0.9	0.6	0.4	0.4	0.3	0.3
Water Year Types ^c												
Wet (32%)	0.3	0.6	2.4	3.7	4.3	3.4	2.0	1.5	0.8	0.6	0.4	0.5
Above Normal (16%)	0.1	0.4	1.1	2.5	3.4	2.7	1.0	0.5	0.3	0.6	0.4	0.4
Below Normal (13%)	0.1	0.2	0.3	0.6	1.8	0.6	0.2	0.2	0.3	0.6	0.4	0.4
Dry (24%)	0.1	0.0	0.1	0.4	1.0	0.8	0.2	0.1	0.2	0.3	0.2	0.2
Critical (15%)	0.0	-0.1	0.0	0.2	0.4	0.2	0.0	-0.1	0.0	0.1	0.2	0.2

Alternative 3

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.4	0.8	3.9	5.1	5.9	5.0	3.2	2.1	0.6	0.7	0.5	0.6
20%	0.2	0.3	2.0	4.0	4.8	3.6	1.8	1.1	0.4	0.7	0.5	0.5
30%	0.2	0.2	0.8	2.5	3.6	2.3	0.8	0.5	0.3	0.7	0.4	0.4
40%	0.1	0.1	0.4	1.2	3.0	1.5	0.5	0.3	0.3	0.6	0.4	0.4
50%	0.1	0.0	0.3	0.7	1.7	1.1	0.2	0.2	0.2	0.5	0.4	0.3
60%	0.1	0.0	0.1	0.4	1.0	0.7	0.1	0.1	0.2	0.5	0.3	0.3
70%	0.0	-0.1	0.0	0.3	0.7	0.6	0.0	0.0	0.1	0.4	0.3	0.2
80%	0.0	-0.1	0.0	0.2	0.4	0.3	0.0	0.0	0.1	0.2	0.2	0.2
90%	-0.1	-0.2	-0.1	0.0	0.3	0.0	-0.1	-0.1	0.0	0.1	0.1	0.1
Long Term												
Full Simulation Period ^b	0.1	0.2	1.0	1.8	2.5	1.8	0.9	0.6	0.4	0.5	0.3	0.3
Water Year Types ^c												
Wet (32%)	0.2	0.6	2.4	3.7	4.3	3.4	2.0	1.5	0.8	0.6	0.4	0.5
Above Normal (16%)	0.1	0.4	1.1	2.4	3.4	2.7	1.0	0.5	0.3	0.6	0.4	0.4
Below Normal (13%)	0.1	0.2	0.3	0.6	1.8	0.6	0.2	0.2	0.2	0.7	0.4	0.4
Dry (24%)	0.1	0.0	0.1	0.4	1.0	0.8	0.2	0.1	0.2	0.3	0.2	0.2
Critical (15%)	0.0	-0.1	0.0	0.2	0.4	0.2	0.0	-0.1	0.0	0.1	0.2	0.2

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0
20%	0.0	0.0	0.1	0.0	0.0	0.0	0.0	-0.1	0.0	0.1	0.0	0.0
30%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.1	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-40-2.6. Steamboat SI d/s of Sutter SI, Monthly Averaged Daily Minimum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.4	0.8	3.9	5.1	5.9	5.0	3.3	2.1	0.6	0.7	0.5	0.6
20%	0.2	0.3	1.9	4.1	4.8	3.6	1.8	1.2	0.4	0.6	0.4	0.5
30%	0.2	0.2	0.8	2.5	3.6	2.6	0.8	0.5	0.3	0.6	0.4	0.4
40%	0.1	0.1	0.4	1.2	3.0	1.5	0.5	0.3	0.3	0.5	0.4	0.4
50%	0.1	0.0	0.3	0.8	1.7	1.0	0.2	0.2	0.2	0.5	0.3	0.3
60%	0.1	0.0	0.1	0.4	1.0	0.7	0.1	0.1	0.2	0.4	0.3	0.3
70%	0.0	-0.1	0.1	0.2	0.6	0.6	0.0	0.0	0.1	0.3	0.3	0.2
80%	0.0	-0.1	0.0	0.2	0.4	0.3	0.0	0.0	0.1	0.2	0.2	0.2
90%	-0.1	-0.2	-0.1	0.1	0.2	0.0	-0.1	-0.1	0.0	0.1	0.1	0.1
Long Term												
Full Simulation Period ^b	0.1	0.2	1.0	1.8	2.5	1.8	0.9	0.6	0.4	0.4	0.3	0.3
Water Year Types ^c												
Wet (32%)	0.3	0.6	2.4	3.7	4.3	3.4	2.0	1.5	0.8	0.6	0.4	0.5
Above Normal (16%)	0.1	0.4	1.1	2.5	3.4	2.7	1.0	0.5	0.3	0.6	0.4	0.4
Below Normal (13%)	0.1	0.2	0.3	0.6	1.8	0.6	0.2	0.2	0.3	0.6	0.4	0.4
Dry (24%)	0.1	0.0	0.1	0.4	1.0	0.8	0.2	0.1	0.2	0.3	0.2	0.2
Critical (15%)	0.0	-0.1	0.0	0.2	0.4	0.2	0.0	-0.1	0.0	0.1	0.2	0.2

Alternative 5

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.4	0.9	3.4	5.0	5.9	5.0	3.3	2.2	0.6	0.8	0.5	1.5
20%	0.3	0.6	1.6	3.7	4.8	3.6	1.8	1.0	0.3	0.7	0.5	1.4
30%	0.2	0.5	0.8	2.3	3.5	2.0	0.9	0.4	0.2	0.7	0.4	0.9
40%	0.2	0.4	0.5	1.2	2.7	1.4	0.5	0.2	0.2	0.6	0.4	0.7
50%	0.1	0.2	0.3	0.8	1.7	1.0	0.2	0.1	0.1	0.5	0.4	0.5
60%	0.1	0.1	0.2	0.5	1.0	0.7	0.1	0.0	0.1	0.5	0.3	0.3
70%	0.0	0.0	0.1	0.3	0.7	0.5	0.0	0.0	0.1	0.4	0.3	0.3
80%	0.0	-0.1	0.0	0.2	0.4	0.3	0.0	-0.1	0.0	0.3	0.2	0.2
90%	-0.1	-0.2	-0.1	0.1	0.3	0.0	-0.1	-0.2	-0.1	0.2	0.1	0.1
Long Term												
Full Simulation Period ^b	0.2	0.4	1.0	1.8	2.4	1.8	0.9	0.6	0.3	0.5	0.4	0.7
Water Year Types ^c												
Wet (32%)	0.3	0.8	2.2	3.6	4.3	3.4	2.1	1.5	0.7	0.7	0.5	1.4
Above Normal (16%)	0.1	0.5	1.1	2.4	3.3	2.6	1.0	0.5	0.2	0.7	0.5	0.7
Below Normal (13%)	0.2	0.3	0.4	0.6	1.7	0.5	0.2	0.1	0.1	0.6	0.4	0.4
Dry (24%)	0.1	0.1	0.1	0.5	1.0	0.8	0.2	0.0	0.1	0.4	0.2	0.2
Critical (15%)	0.0	-0.1	0.1	0.3	0.4	0.2	-0.1	-0.1	0.0	0.2	0.2	0.2

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.1	0.1	-0.4	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	1.0
20%	0.1	0.3	-0.3	-0.4	0.0	0.0	0.0	-0.2	-0.1	0.1	0.0	0.9
30%	0.0	0.3	0.0	-0.3	-0.1	-0.5	0.0	0.0	-0.1	0.1	0.1	0.5
40%	0.1	0.2	0.1	0.0	-0.3	0.0	0.0	0.0	-0.1	0.1	0.0	0.3
50%	0.0	0.2	0.1	0.0	0.0	0.0	0.0	-0.1	-0.1	0.1	0.0	0.1
60%	0.0	0.1	0.1	0.0	-0.1	0.0	0.0	-0.1	-0.1	0.1	0.0	0.0
70%	0.0	0.1	0.1	0.0	0.0	0.0	0.0	-0.1	-0.1	0.1	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.0	0.0
90%	0.0	0.0	0.1	0.0	0.1	0.0	0.0	-0.1	-0.1	0.1	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.0	0.3
Water Year Types ^c												
Wet (32%)	0.1	0.2	-0.2	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.9
Above Normal (16%)	0.0	0.2	0.1	-0.1	-0.1	-0.2	0.0	-0.1	-0.1	0.1	0.0	0.3
Below Normal (13%)	0.0	0.1	0.0	0.0	-0.1	-0.1	0.0	-0.1	-0.2	0.1	0.1	0.0
Dry (24%)	0.0	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.1	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 **C.41. Old River at Tracy Boulevard Water Surface Elevation**

Figure C-41-1-1. Old River at Tracy Blvd, Monthly Averaged Daily Maximum Elevation, October

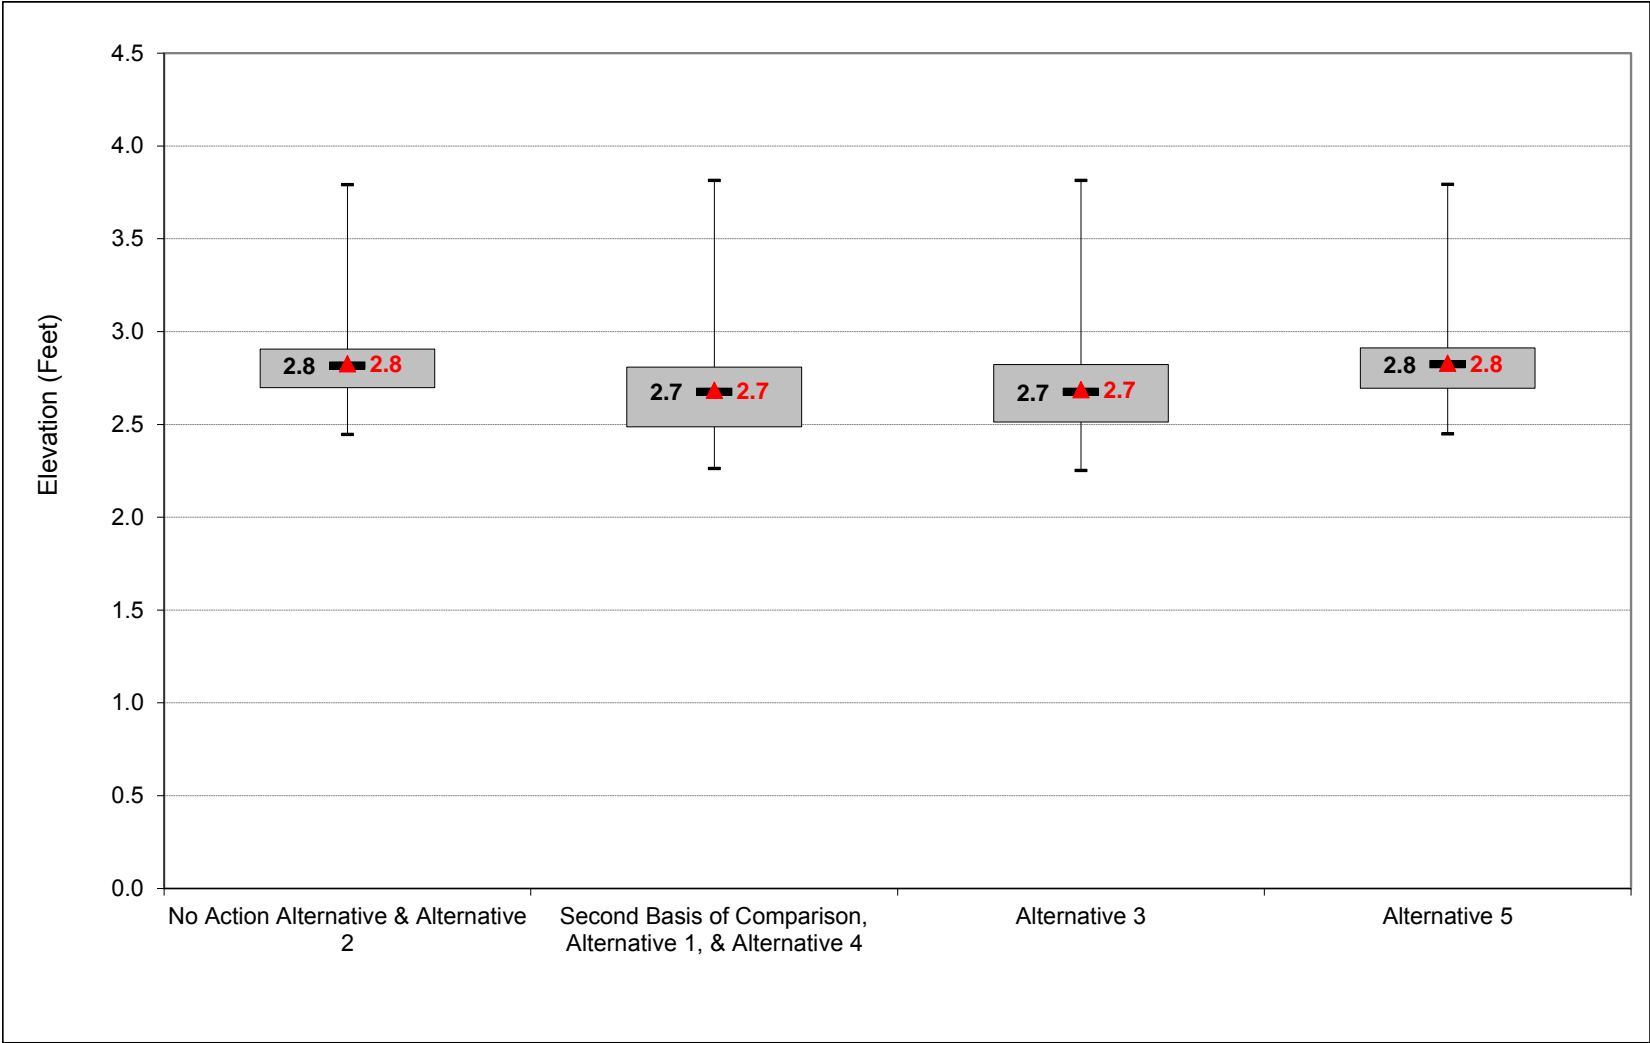


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-41-1-2. Old River at Tracy Blvd, Monthly Averaged Daily Maximum Elevation, November

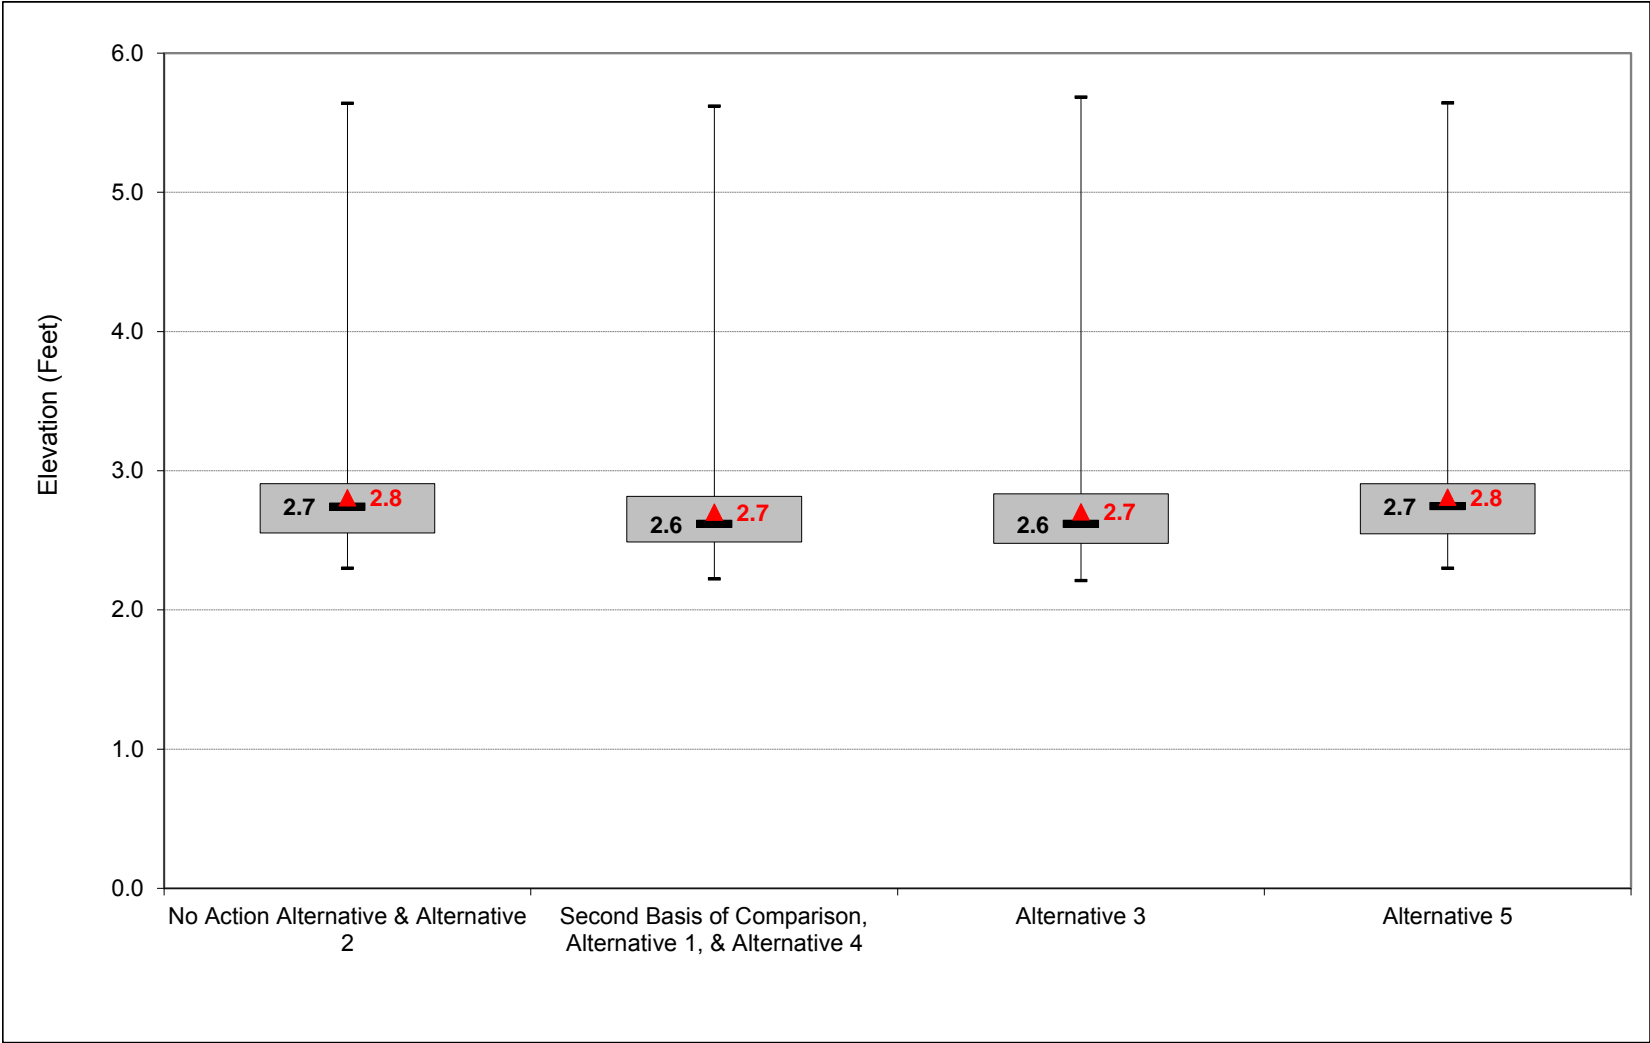


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-41-1-3. Old River at Tracy Blvd, Monthly Averaged Daily Maximum Elevation, December

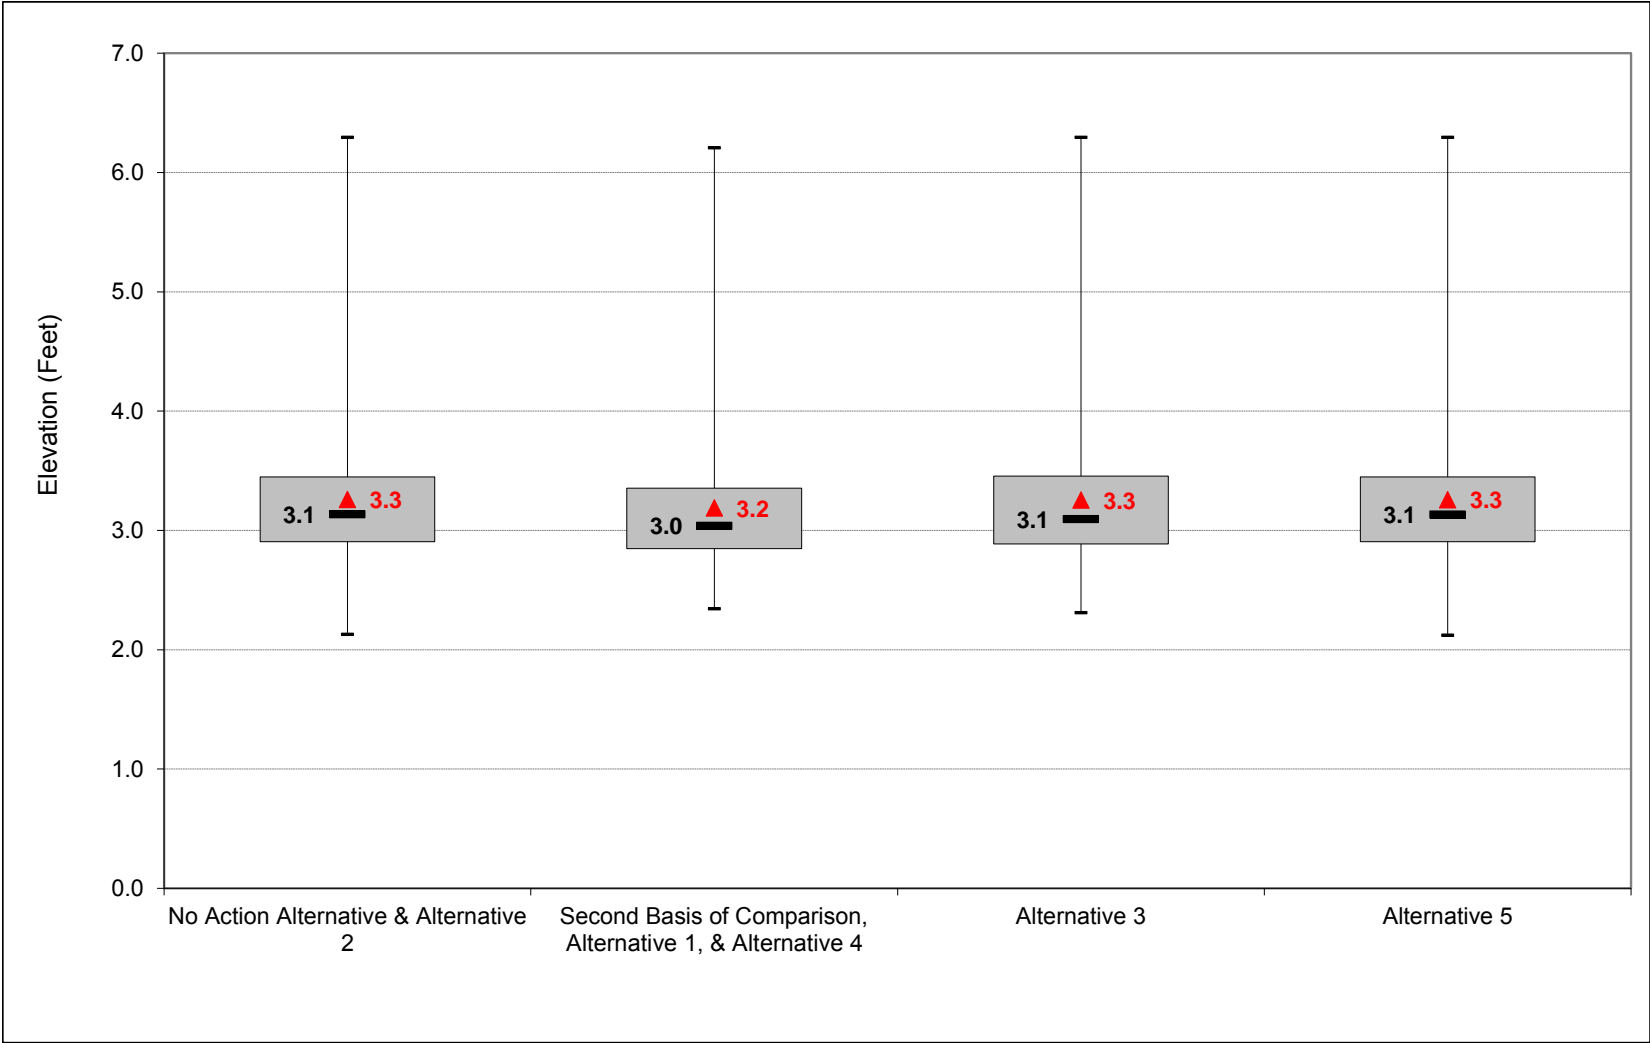


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-41-1-4. Old River at Tracy Blvd, Monthly Averaged Daily Maximum Elevation, January

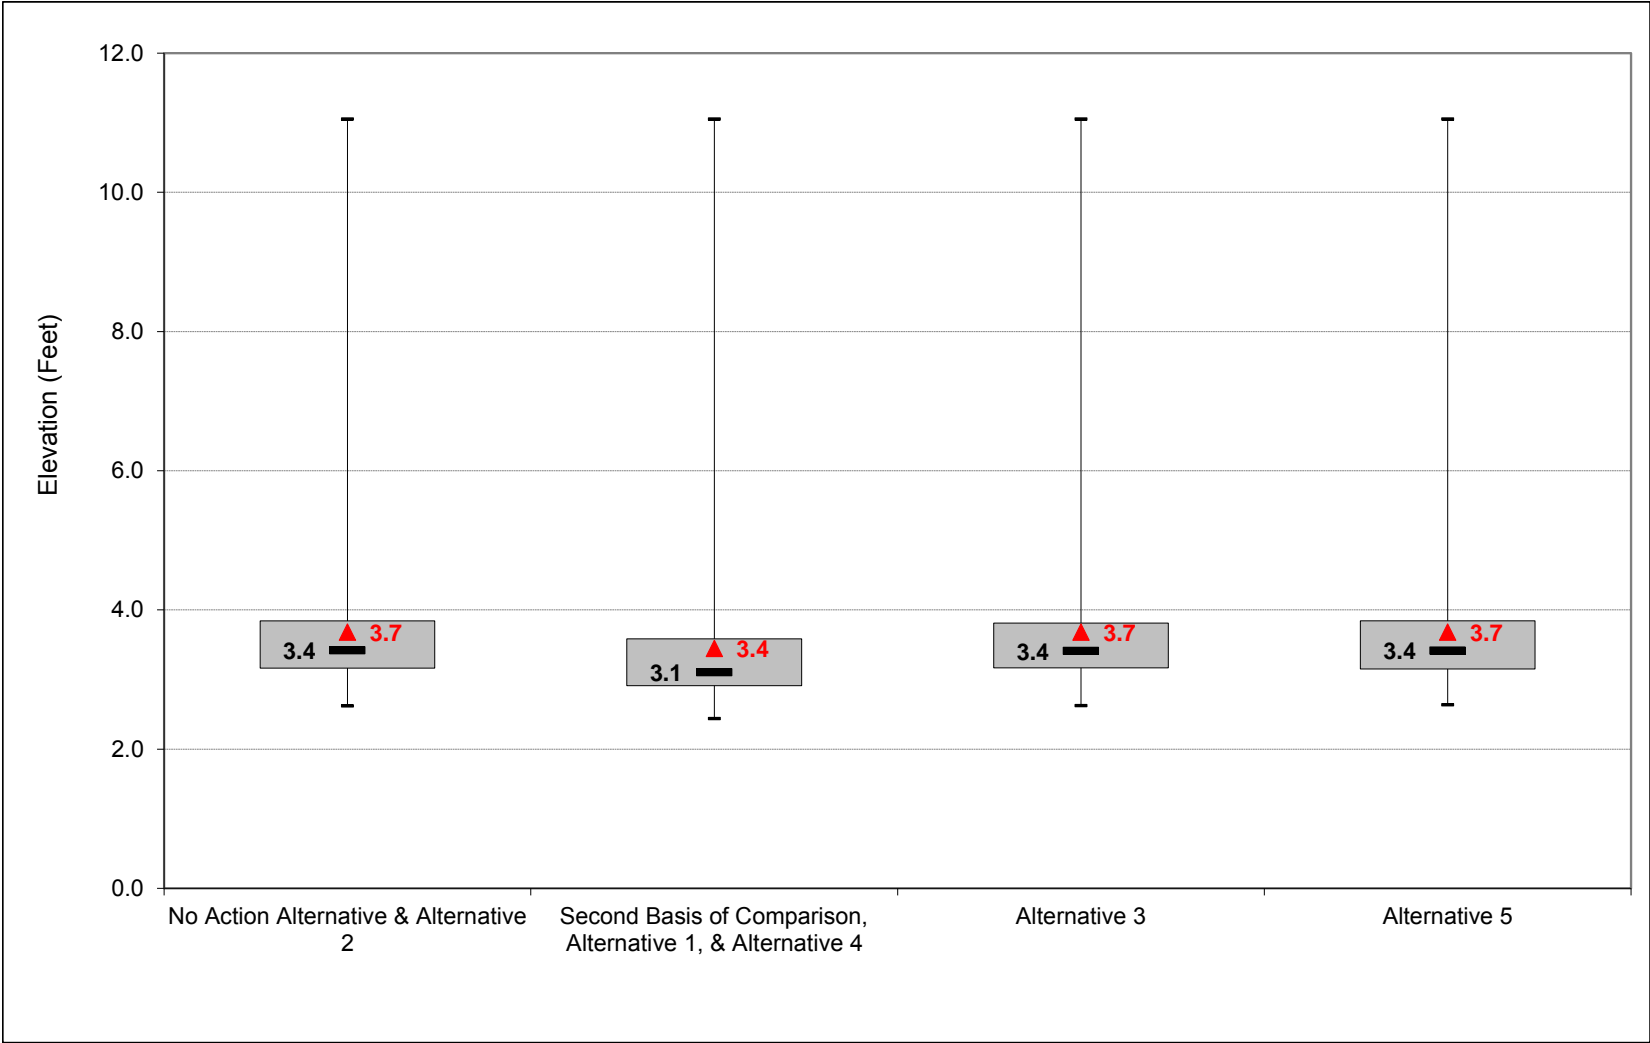


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-41-1-5. Old River at Tracy Blvd, Monthly Averaged Daily Maximum Elevation, February

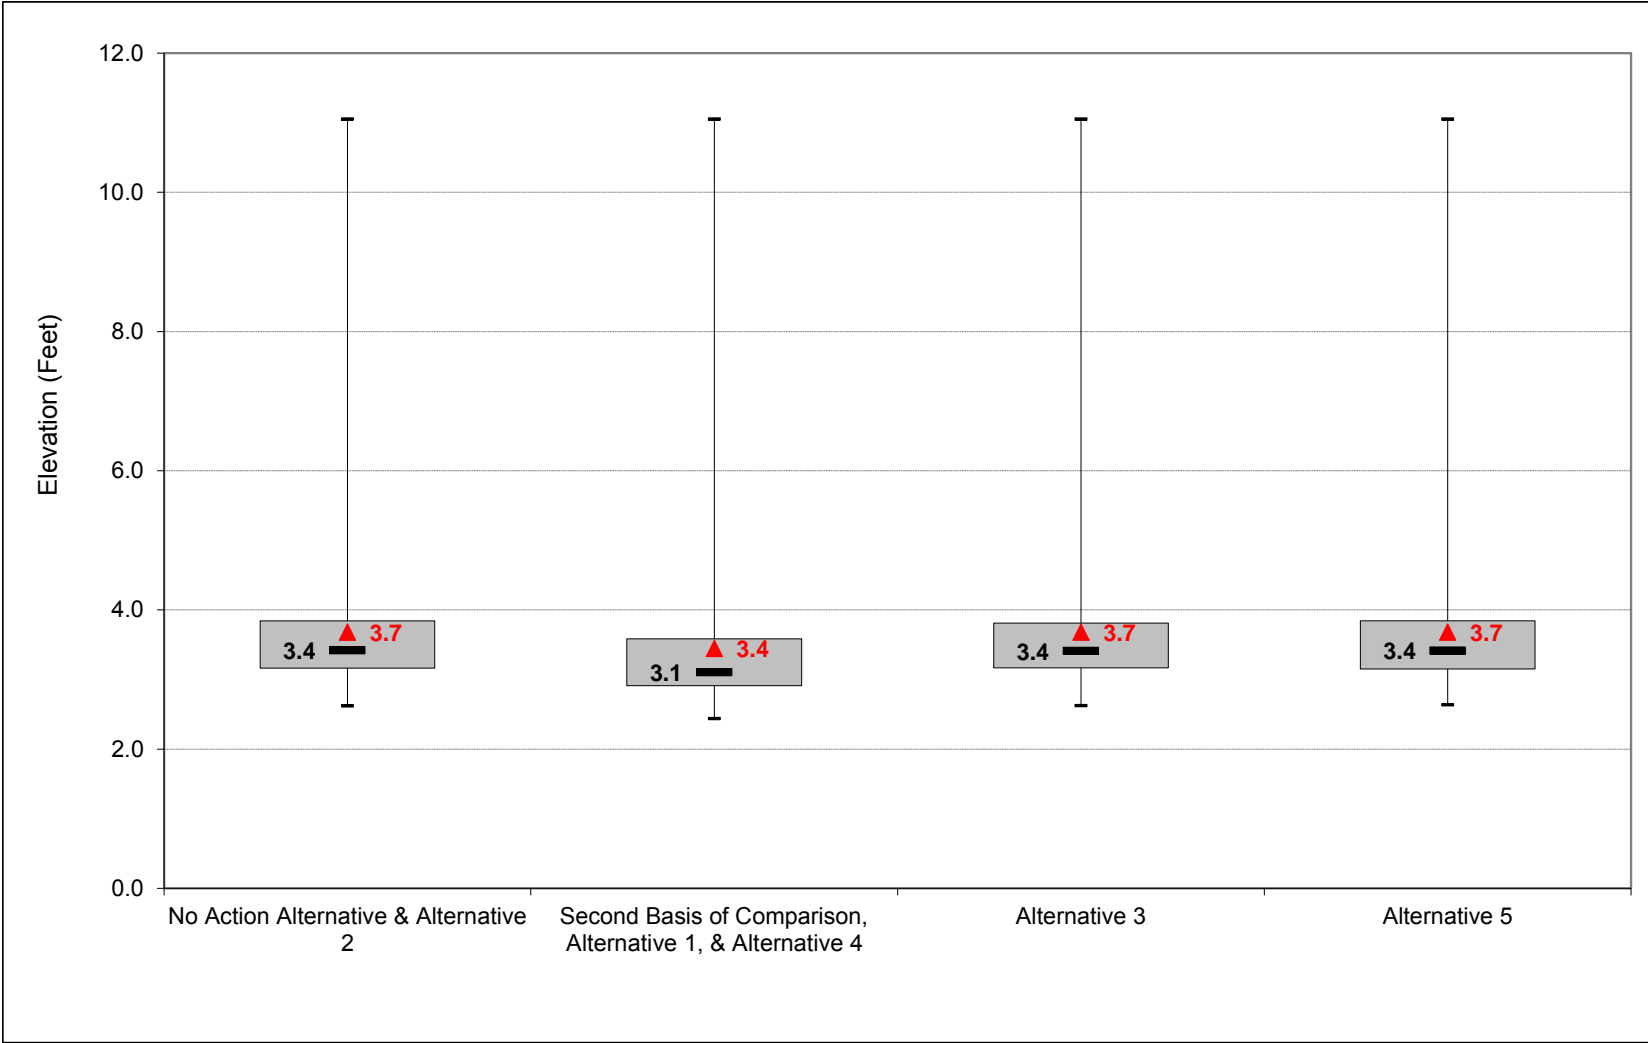


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-41-1-6. Old River at Tracy Blvd, Monthly Averaged Daily Maximum Elevation, March

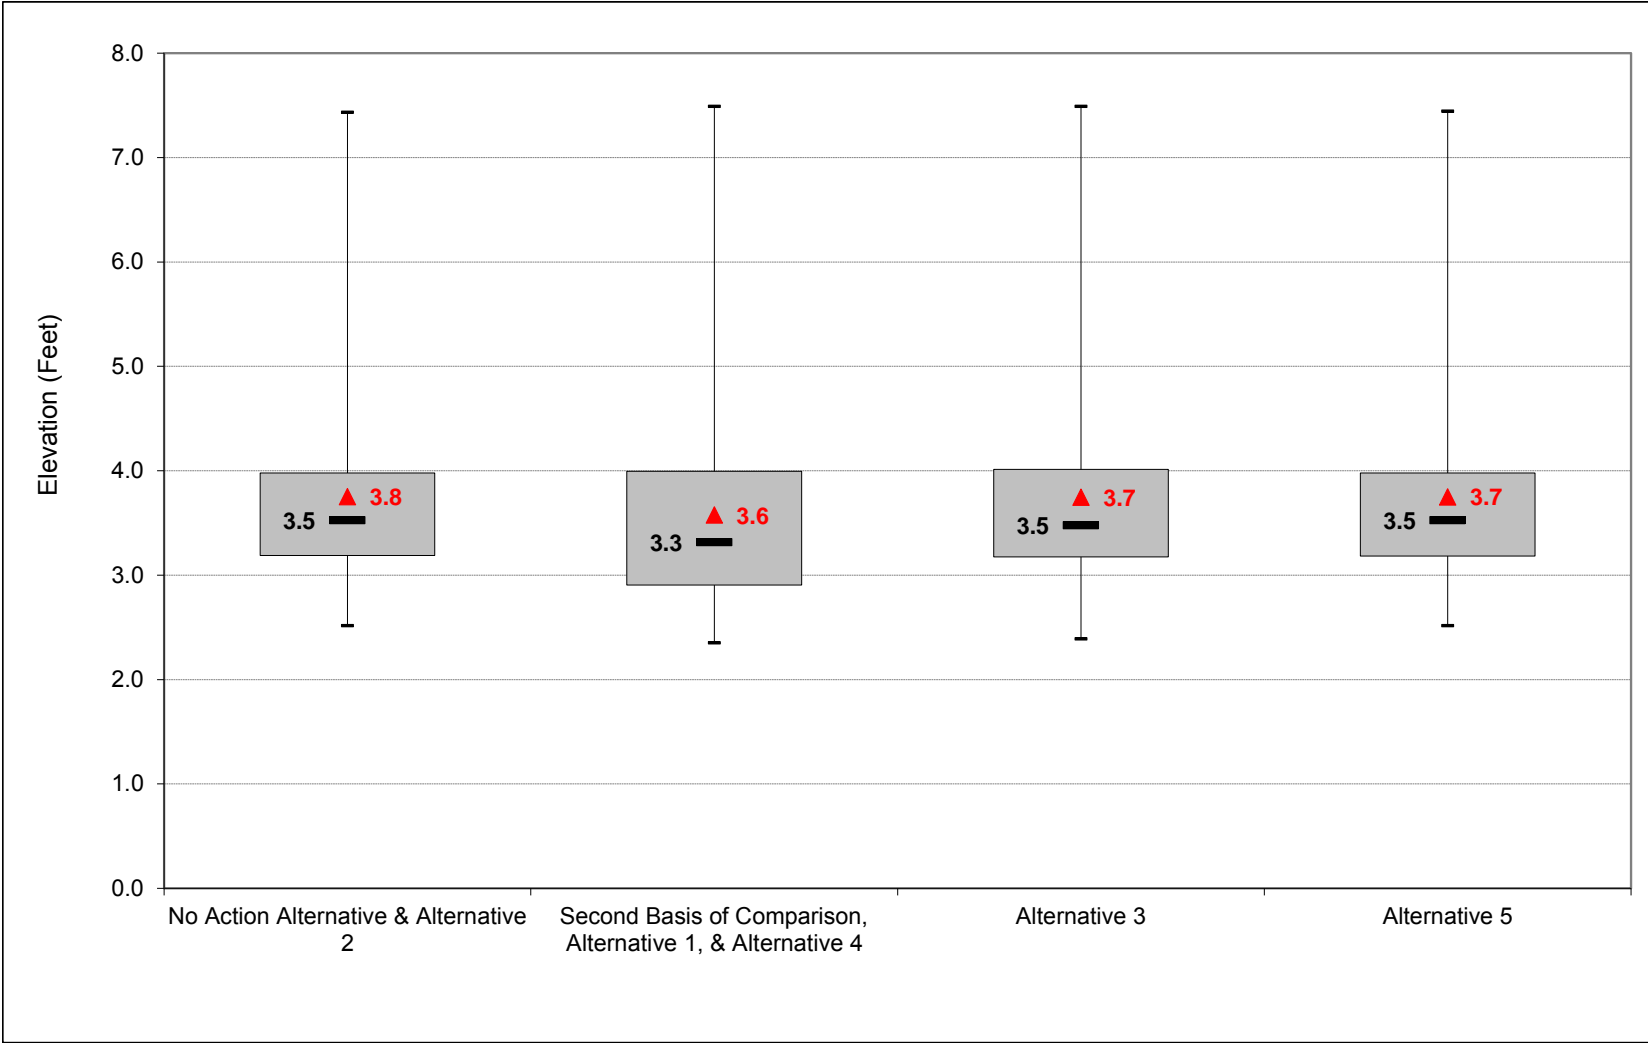


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-41-1-7. Old River at Tracy Blvd, Monthly Averaged Daily Maximum Elevation, April

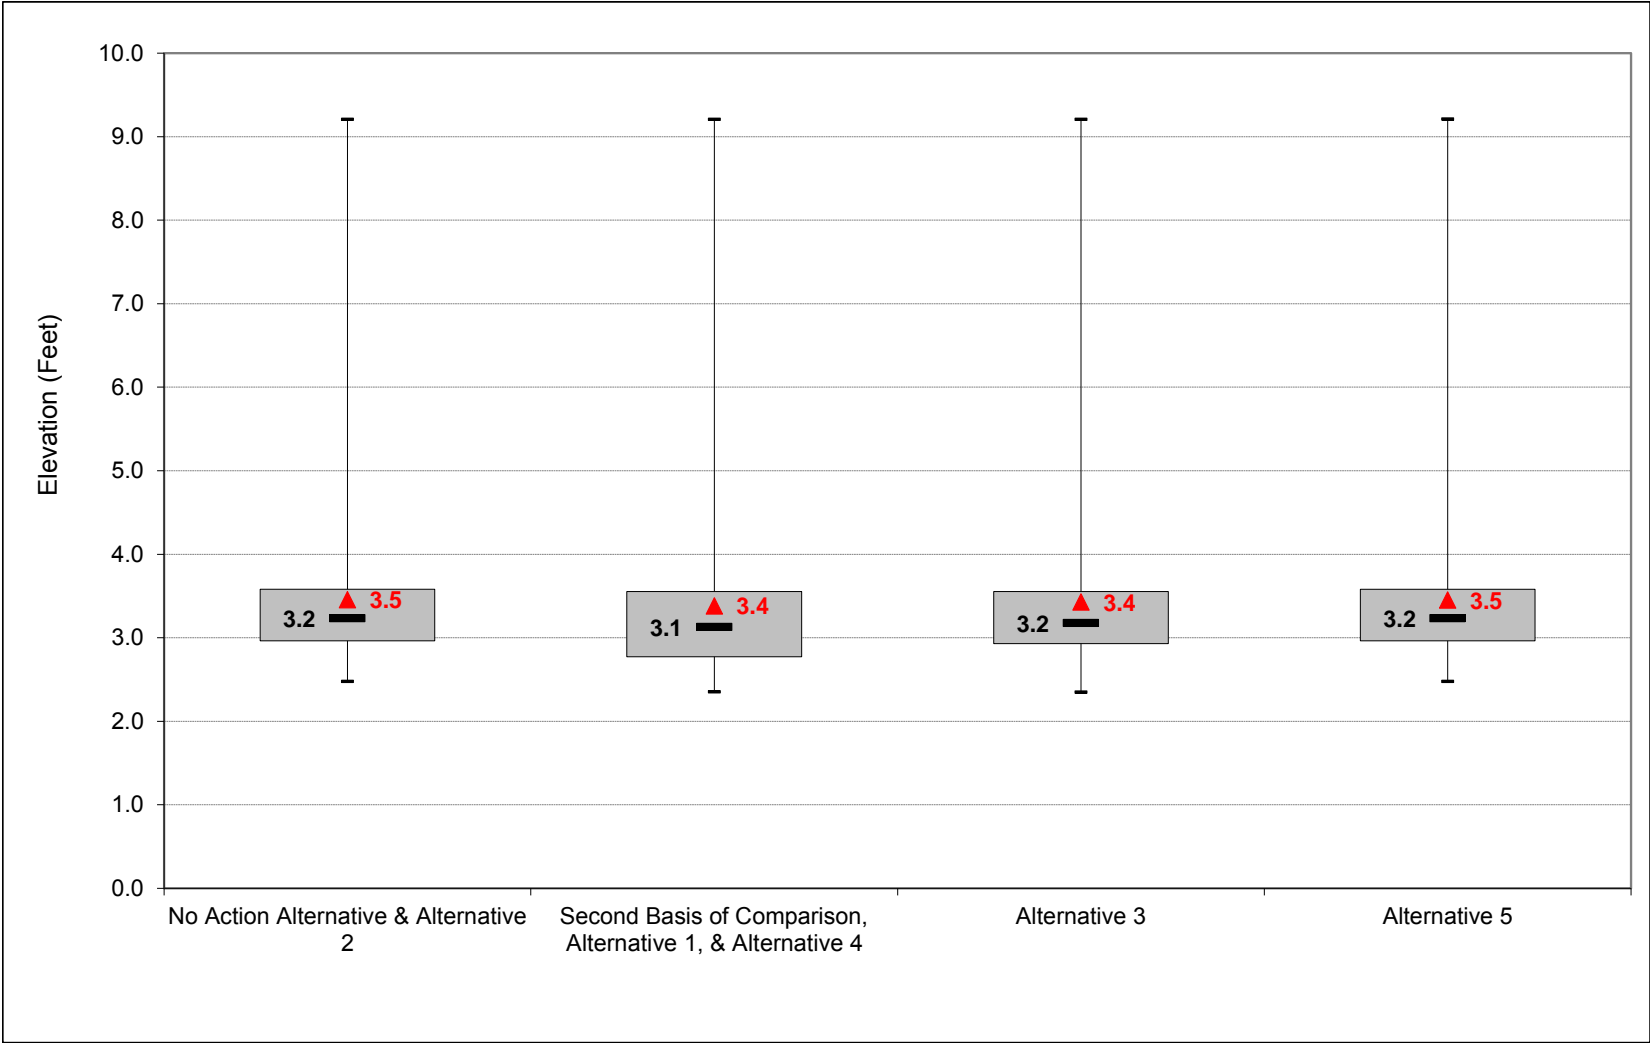


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-41-1-8. Old River at Tracy Blvd, Monthly Averaged Daily Maximum Elevation, May

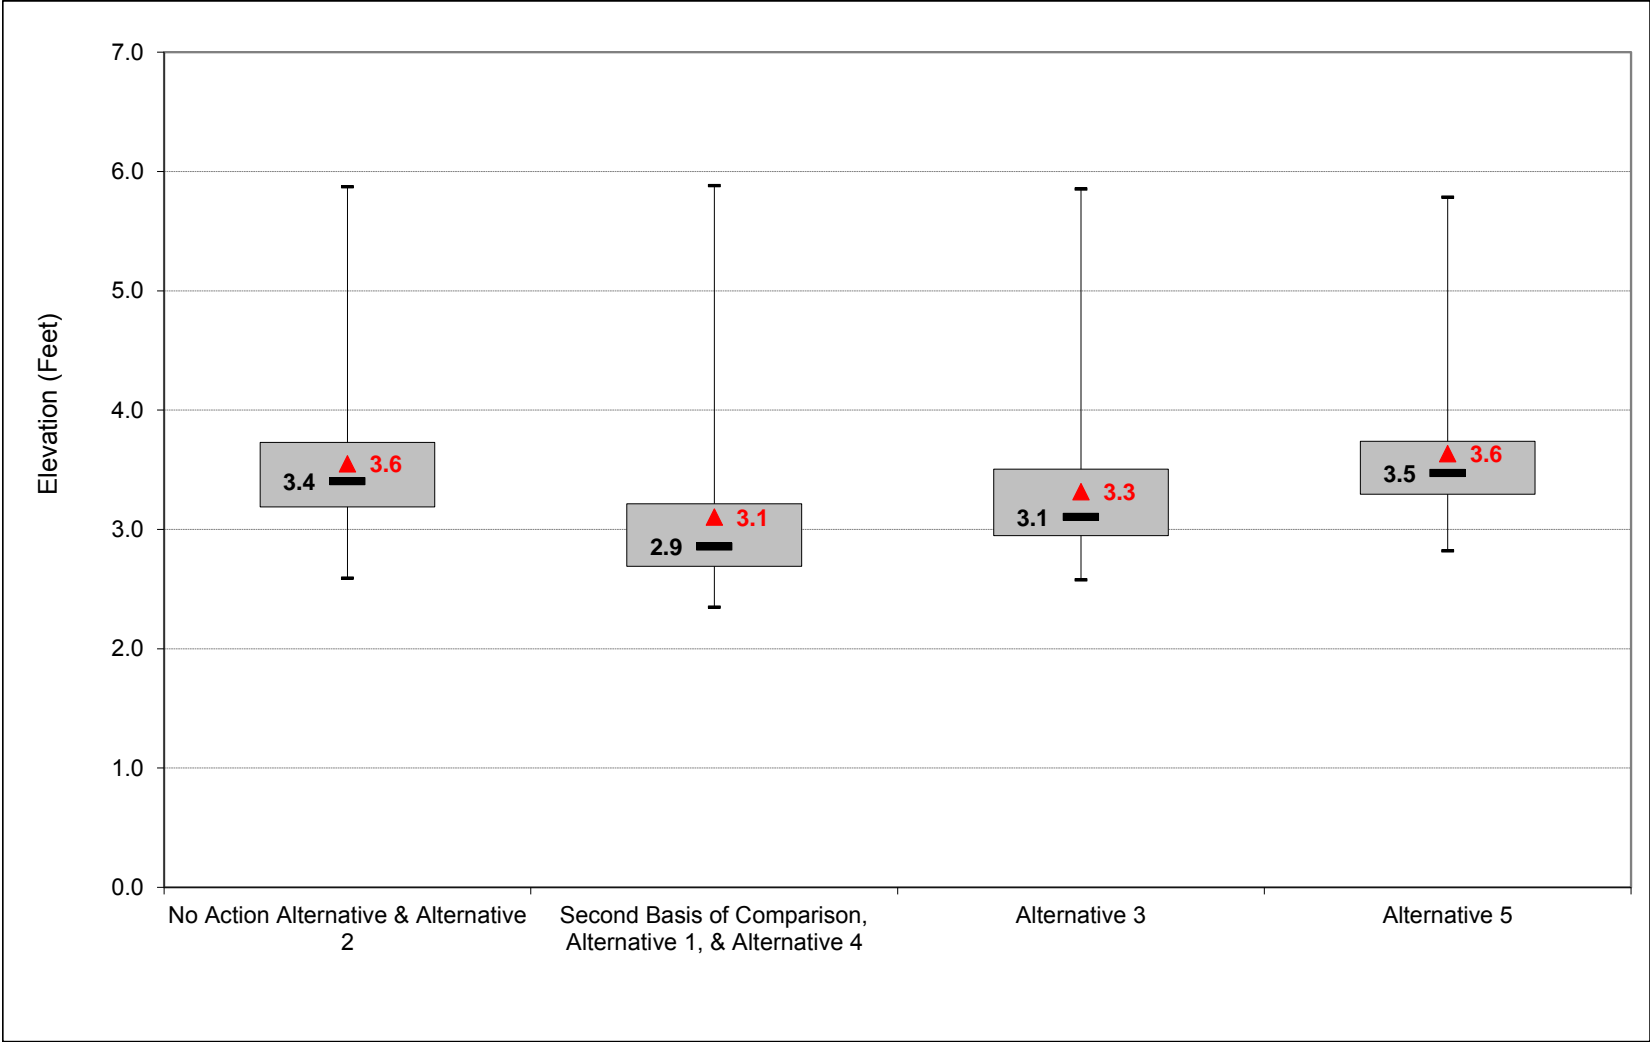


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-41-1-9. Old River at Tracy Blvd, Monthly Averaged Daily Maximum Elevation, June

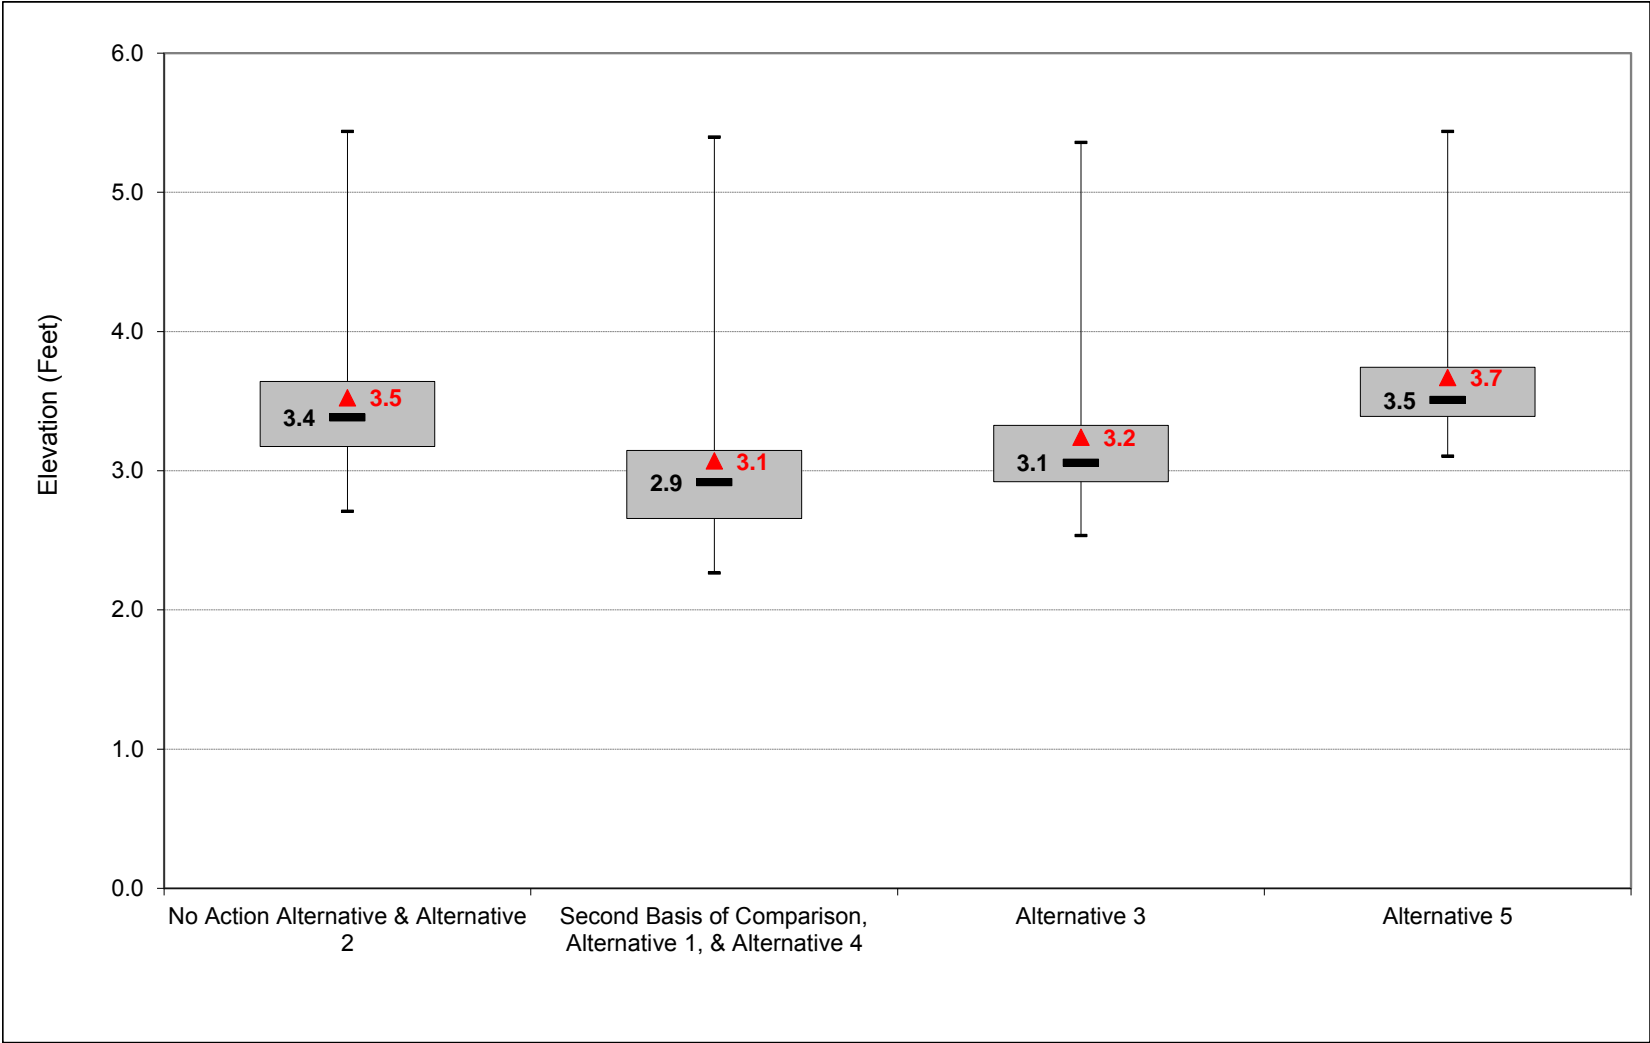


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-41-1-10. Old River at Tracy Blvd, Monthly Averaged Daily Maximum Elevation, July

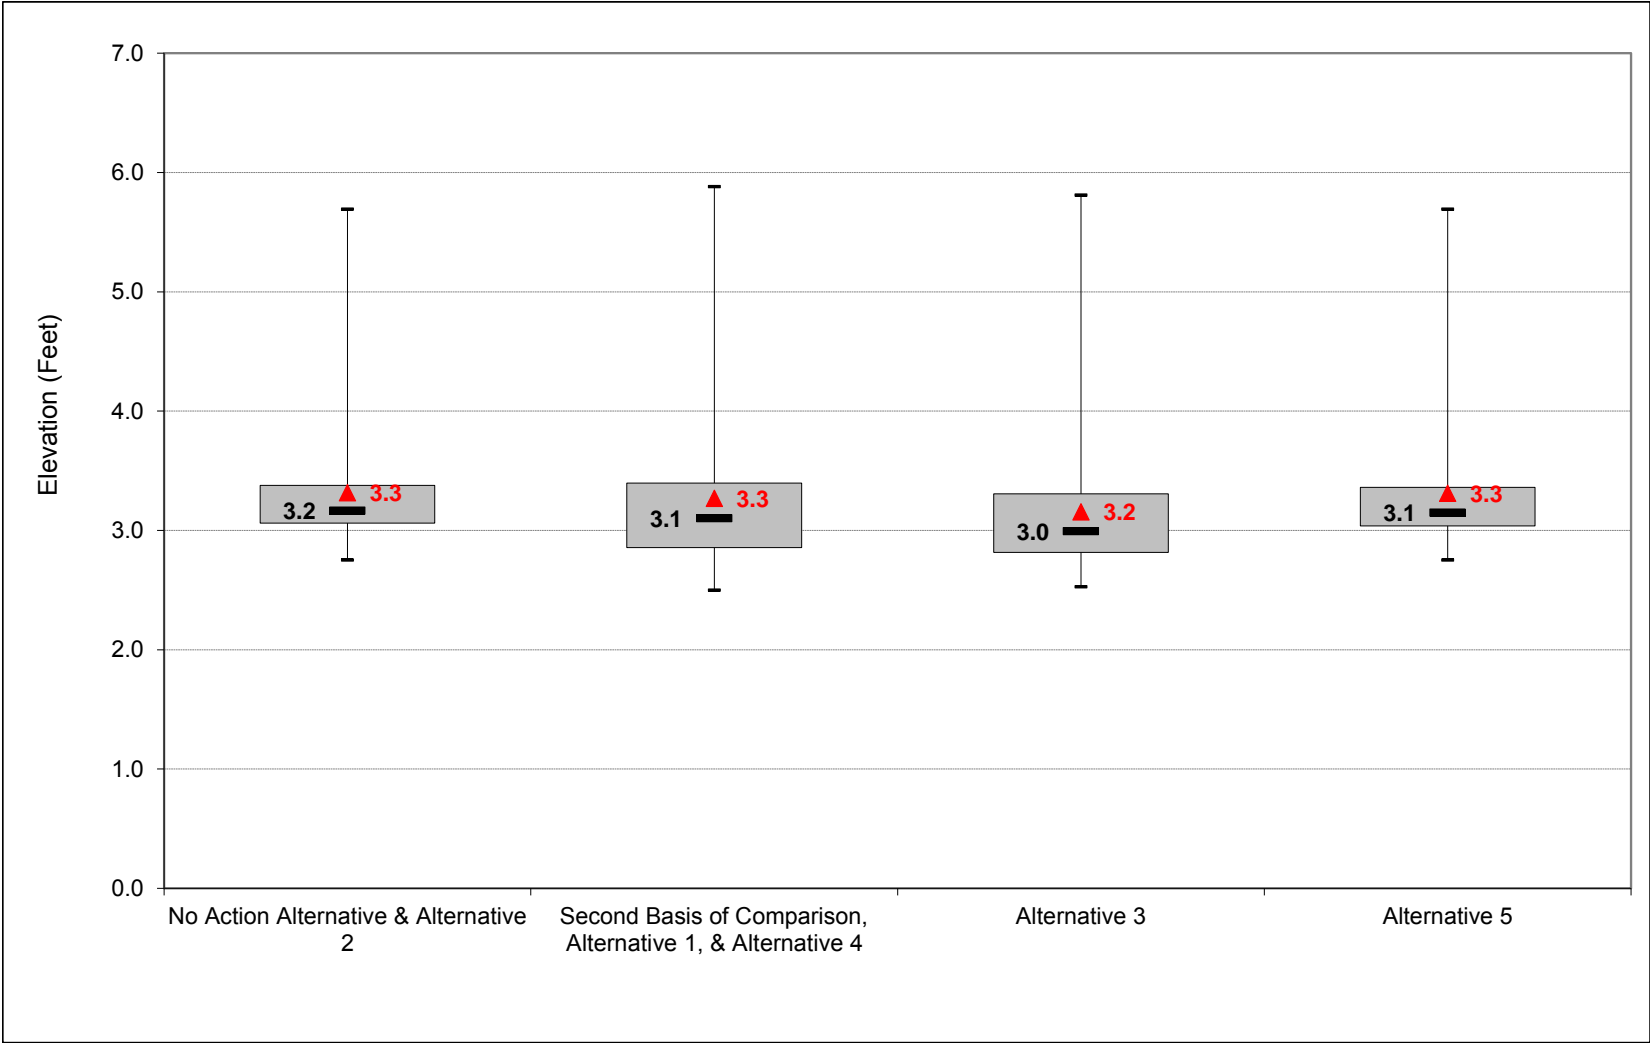


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-41-1-11. Old River at Tracy Blvd, Monthly Averaged Daily Maximum Elevation, August

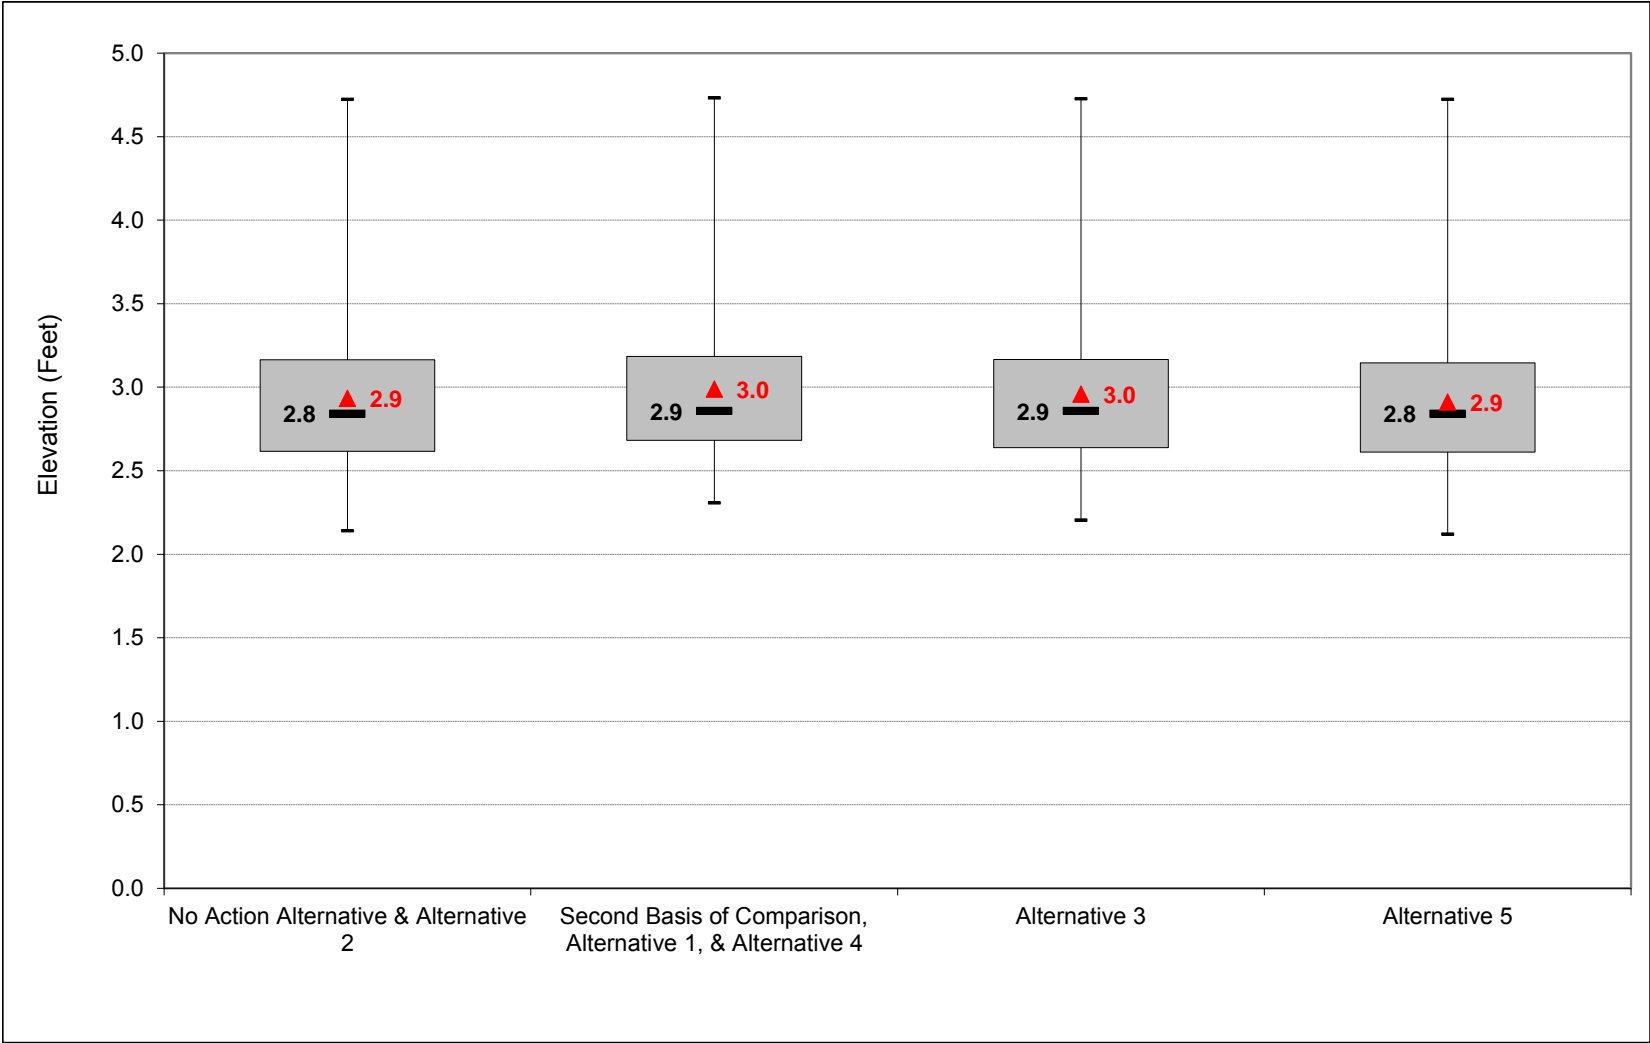

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-41-1-12. Old River at Tracy Blvd, Monthly Averaged Daily Maximum Elevation, September

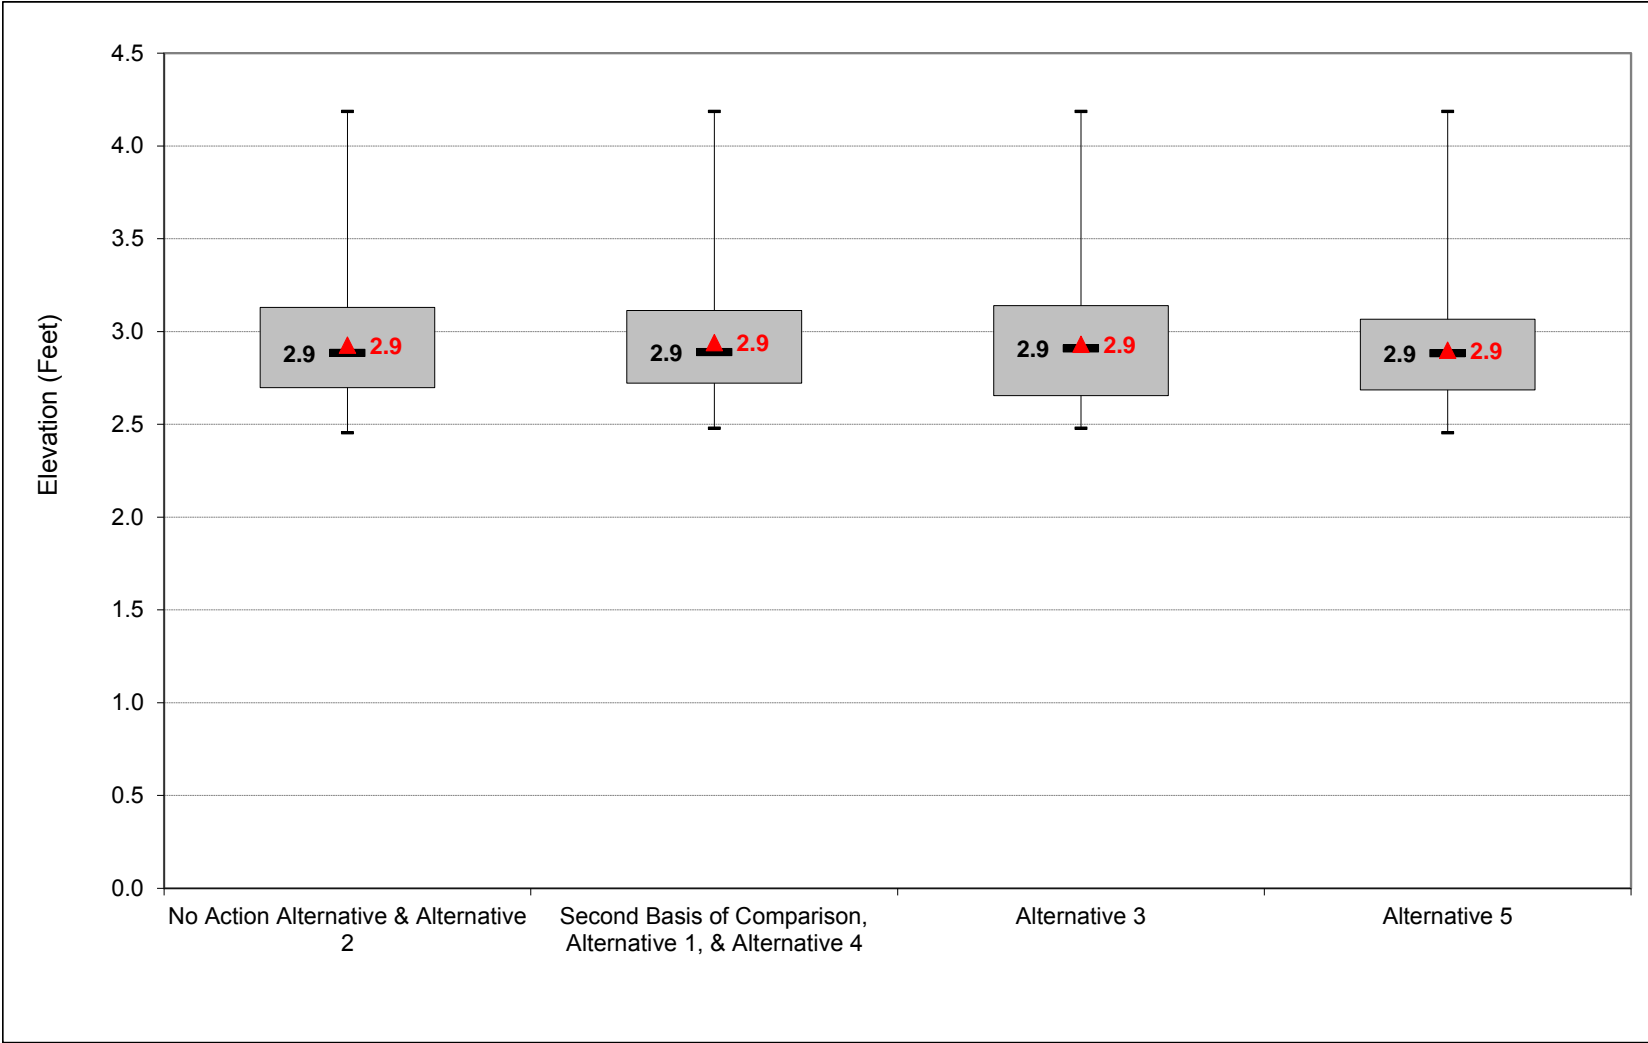

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-41-1-1. Old River at Tracy Blvd, Monthly Averaged Daily Maximum Elevation

No Action Alternative

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3.1	3.1	3.9	4.4	4.5	4.4	4.4	4.4	3.9	3.5	3.3	3.2
20%	2.9	2.9	3.5	4.1	4.2	3.8	3.9	3.8	3.5	3.2	3.1	3.1
30%	2.9	2.9	3.4	3.7	3.9	3.5	3.6	3.6	3.3	3.1	3.1	3.0
40%	2.9	2.8	3.3	3.5	3.7	3.3	3.5	3.5	3.2	3.0	3.0	2.9
50%	2.8	2.7	3.1	3.4	3.5	3.2	3.4	3.4	3.2	2.8	2.9	2.8
60%	2.8	2.7	3.1	3.3	3.4	3.1	3.3	3.3	3.1	2.7	2.8	2.8
70%	2.7	2.6	3.0	3.2	3.3	3.0	3.2	3.2	3.1	2.6	2.7	2.7
80%	2.7	2.5	2.8	3.1	3.2	2.9	3.1	3.1	3.0	2.6	2.7	2.7
90%	2.6	2.5	2.7	3.0	2.9	2.8	3.0	3.0	2.9	2.5	2.6	2.6
Long Term												
Full Simulation Period ^b	2.8	2.8	3.3	3.7	3.8	3.5	3.6	3.5	3.3	2.9	2.9	2.9
Water Year Types^c												
Wet (32%)	2.9	2.9	3.6	4.4	4.4	4.1	4.1	4.0	3.7	3.3	2.9	3.0
Above Normal (16%)	2.8	2.7	3.2	3.8	3.9	3.4	3.6	3.5	3.2	2.9	2.7	2.7
Below Normal (13%)	2.8	2.7	3.1	3.3	3.5	3.0	3.3	3.3	3.1	2.6	2.8	2.8
Dry (24%)	2.7	2.7	3.0	3.2	3.3	3.2	3.2	3.2	3.1	2.6	3.0	2.8
Critical (15%)	2.9	2.9	3.2	3.2	3.3	3.1	3.1	3.2	3.2	3.0	3.1	3.1

Alternative 1

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3.0	3.0	3.7	4.2	4.7	4.5	4.2	4.1	4.2	3.5	3.3	3.1
20%	2.8	2.9	3.4	3.8	4.2	3.9	3.3	3.3	3.5	3.2	3.1	3.0
30%	2.8	2.8	3.2	3.4	3.8	3.5	3.1	3.1	3.3	3.1	3.1	3.0
40%	2.7	2.7	3.1	3.2	3.5	3.2	2.9	3.0	3.2	3.0	3.0	2.9
50%	2.7	2.6	3.0	3.1	3.3	3.1	2.9	2.9	3.1	2.9	2.9	2.8
60%	2.6	2.6	2.9	3.0	3.1	3.0	2.8	2.8	3.0	2.8	2.8	2.8
70%	2.5	2.5	2.9	2.9	3.0	2.9	2.7	2.7	2.9	2.7	2.8	2.7
80%	2.5	2.5	2.8	2.9	2.8	2.7	2.7	2.6	2.8	2.7	2.7	2.6
90%	2.4	2.4	2.7	2.8	2.6	2.6	2.6	2.5	2.7	2.6	2.6	2.6
Long Term												
Full Simulation Period ^b	2.7	2.7	3.2	3.4	3.6	3.4	3.1	3.1	3.3	3.0	2.9	2.9
Water Year Types^c												
Wet (32%)	2.7	2.8	3.5	4.2	4.3	4.2	3.7	3.5	3.9	3.3	3.0	2.9
Above Normal (16%)	2.7	2.7	3.1	3.4	3.7	3.3	2.9	2.9	3.1	2.9	2.7	2.6
Below Normal (13%)	2.6	2.6	3.0	3.0	3.4	2.9	2.8	2.7	2.9	2.6	2.9	2.8
Dry (24%)	2.6	2.6	2.9	3.0	3.0	3.0	2.8	2.8	3.0	2.8	3.0	2.8
Critical (15%)	2.8	2.8	3.1	3.1	3.1	2.9	2.9	3.0	3.0	3.1	3.1	3.1

Alternative 1 minus No Action Alternative

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-0.1	-0.1	-0.1	-0.2	0.2	0.1	-0.1	-0.3	0.3	0.0	0.0	-0.1
20%	-0.1	-0.1	-0.1	-0.3	0.0	0.1	-0.6	-0.5	0.0	0.0	0.0	-0.1
30%	-0.1	-0.1	-0.1	-0.3	0.0	0.0	-0.5	-0.5	0.0	0.0	0.0	0.0
40%	-0.1	-0.1	-0.1	-0.3	-0.3	-0.1	-0.6	-0.5	-0.1	0.0	0.0	0.0
50%	-0.1	-0.1	-0.1	-0.3	-0.2	-0.1	-0.5	-0.5	-0.1	0.0	0.0	0.0
60%	-0.1	-0.1	-0.1	-0.3	-0.3	-0.1	-0.5	-0.5	-0.1	0.1	0.0	0.0
70%	-0.2	-0.1	-0.1	-0.3	-0.3	-0.1	-0.5	-0.5	-0.2	0.1	0.0	0.0
80%	-0.2	-0.1	0.0	-0.3	-0.3	-0.2	-0.5	-0.5	-0.2	0.1	0.0	0.0
90%	-0.2	-0.1	0.0	-0.2	-0.3	-0.2	-0.4	-0.5	-0.2	0.1	0.1	-0.1
Long Term												
Full Simulation Period ^b	-0.1	-0.1	-0.1	-0.2	-0.2	-0.1	-0.4	-0.5	0.0	0.1	0.0	0.0
Water Year Types^c												
Wet (32%)	-0.2	-0.1	-0.1	-0.2	-0.1	0.0	-0.4	-0.5	0.1	0.0	0.0	-0.1
Above Normal (16%)	-0.1	-0.1	-0.1	-0.4	-0.2	0.0	-0.7	-0.7	-0.1	0.0	0.1	-0.1
Below Normal (13%)	-0.2	-0.2	0.0	-0.3	-0.1	-0.1	-0.5	-0.6	-0.2	0.0	0.1	0.0
Dry (24%)	-0.1	-0.1	0.0	-0.2	-0.3	-0.2	-0.4	-0.4	-0.1	0.1	0.0	0.0
Critical (15%)	-0.1	-0.1	-0.1	-0.1	-0.2	-0.1	-0.2	-0.2	-0.1	0.1	0.0	0.0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-41-1-2. Old River at Tracy Blvd, Monthly Averaged Daily Maximum Elevation

No Action Alternative

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3.1	3.1	3.9	4.4	4.5	4.4	4.4	4.4	3.9	3.5	3.3	3.2
20%	2.9	2.9	3.5	4.1	4.2	3.8	3.9	3.8	3.5	3.2	3.1	3.1
30%	2.9	2.9	3.4	3.7	3.9	3.5	3.6	3.6	3.3	3.1	3.1	3.0
40%	2.9	2.8	3.3	3.5	3.7	3.3	3.5	3.5	3.2	3.0	3.0	2.9
50%	2.8	2.7	3.1	3.4	3.5	3.2	3.4	3.4	3.2	2.8	2.9	2.8
60%	2.8	2.7	3.1	3.3	3.4	3.1	3.3	3.3	3.1	2.7	2.8	2.8
70%	2.7	2.6	3.0	3.2	3.3	3.0	3.2	3.2	3.1	2.6	2.7	2.7
80%	2.7	2.5	2.8	3.1	3.2	2.9	3.1	3.1	3.0	2.6	2.7	2.7
90%	2.6	2.5	2.7	3.0	2.9	2.8	3.0	3.0	2.9	2.5	2.6	2.6
Long Term												
Full Simulation Period ^b	2.8	2.8	3.3	3.7	3.8	3.5	3.6	3.5	3.3	2.9	2.9	2.9
Water Year Types^c												
Wet (32%)	2.9	2.9	3.6	4.4	4.4	4.1	4.1	4.0	3.7	3.3	2.9	3.0
Above Normal (16%)	2.8	2.7	3.2	3.8	3.9	3.4	3.6	3.5	3.2	2.9	2.7	2.7
Below Normal (13%)	2.8	2.7	3.1	3.3	3.5	3.0	3.3	3.3	3.1	2.6	2.8	2.8
Dry (24%)	2.7	2.7	3.0	3.2	3.3	3.2	3.2	3.2	3.1	2.6	3.0	2.8
Critical (15%)	2.9	2.9	3.2	3.2	3.3	3.1	3.1	3.2	3.2	3.0	3.1	3.1

Alternative 3

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3.0	3.0	3.8	4.4	4.7	4.6	4.2	4.0	3.8	3.6	3.3	3.2
20%	2.9	2.8	3.5	4.2	4.2	3.8	3.6	3.4	3.4	3.2	3.2	3.1
30%	2.8	2.8	3.3	3.7	3.9	3.5	3.3	3.2	3.2	3.1	3.1	3.0
40%	2.7	2.7	3.2	3.5	3.7	3.4	3.2	3.2	3.1	2.9	3.0	2.9
50%	2.7	2.6	3.1	3.4	3.5	3.2	3.1	3.1	3.0	2.9	2.9	2.8
60%	2.6	2.6	3.0	3.3	3.4	3.1	3.0	3.0	2.9	2.8	2.8	2.8
70%	2.6	2.5	2.9	3.2	3.2	3.0	3.0	3.0	2.8	2.7	2.7	2.7
80%	2.4	2.4	2.9	3.1	3.1	2.9	2.9	2.9	2.8	2.6	2.6	2.6
90%	2.4	2.4	2.8	3.0	2.9	2.7	2.8	2.8	2.7	2.5	2.6	2.6
Long Term												
Full Simulation Period ^b	2.7	2.7	3.3	3.7	3.7	3.4	3.3	3.2	3.2	3.0	2.9	2.9
Water Year Types^c												
Wet (32%)	2.7	2.8	3.6	4.4	4.4	4.1	3.8	3.6	3.6	3.3	3.0	2.9
Above Normal (16%)	2.7	2.7	3.2	3.8	3.9	3.3	3.2	3.1	3.0	2.8	2.7	2.6
Below Normal (13%)	2.6	2.6	3.1	3.3	3.5	2.9	3.1	3.0	2.9	2.6	2.7	2.8
Dry (24%)	2.6	2.6	3.0	3.2	3.3	3.1	3.0	3.0	2.9	2.7	3.0	2.8
Critical (15%)	2.9	2.8	3.2	3.2	3.3	3.1	3.1	3.2	3.0	3.1	3.1	3.1

Alternative 3 minus No Action Alternative

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-0.1	-0.1	0.0	0.0	0.2	0.1	-0.1	-0.3	0.0	0.1	0.0	0.0
20%	-0.1	-0.1	0.0	0.0	0.0	0.0	-0.3	-0.4	-0.2	0.0	0.0	0.0
30%	-0.1	-0.1	0.0	0.0	0.0	0.0	-0.3	-0.3	-0.1	0.0	0.0	0.0
40%	-0.1	-0.1	-0.1	0.0	0.0	0.0	-0.3	-0.3	-0.2	0.0	0.0	0.0
50%	-0.1	-0.1	0.0	0.0	0.0	-0.1	-0.3	-0.3	-0.2	0.0	0.0	0.0
60%	-0.1	-0.1	-0.1	0.0	0.0	0.0	-0.3	-0.3	-0.2	0.1	0.0	0.0
70%	-0.2	-0.1	0.0	0.0	0.0	0.0	-0.2	-0.2	-0.2	0.0	0.0	0.0
80%	-0.2	-0.1	0.0	0.0	0.0	0.0	-0.2	-0.2	-0.2	0.0	0.0	0.0
90%	-0.2	-0.1	0.1	0.0	-0.1	-0.1	-0.2	-0.3	-0.3	0.0	0.0	-0.1
Long Term												
Full Simulation Period ^b	-0.1	-0.1	0.0	0.0	0.0	0.0	-0.2	-0.3	-0.2	0.0	0.0	0.0
Water Year Types^c												
Wet (32%)	-0.2	-0.1	0.0	0.0	0.0	0.0	-0.3	-0.4	-0.1	0.0	0.0	0.0
Above Normal (16%)	-0.1	-0.1	0.0	0.0	0.0	-0.1	-0.4	-0.5	-0.2	0.0	0.0	-0.1
Below Normal (13%)	-0.2	-0.2	0.0	0.0	0.0	-0.1	-0.3	-0.3	-0.2	0.0	0.0	-0.1
Dry (24%)	-0.1	-0.1	0.0	0.0	0.0	0.0	-0.2	-0.2	-0.2	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	-0.1	0.1	0.0	0.0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-41-1-3. Old River at Tracy Blvd, Monthly Averaged Daily Maximum Elevation

No Action Alternative

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3.1	3.1	3.9	4.4	4.5	4.4	4.4	4.4	3.9	3.5	3.3	3.2
20%	2.9	2.9	3.5	4.1	4.2	3.8	3.9	3.8	3.5	3.2	3.1	3.1
30%	2.9	2.9	3.4	3.7	3.9	3.5	3.6	3.6	3.3	3.1	3.1	3.0
40%	2.9	2.8	3.3	3.5	3.7	3.3	3.5	3.5	3.2	3.0	3.0	2.9
50%	2.8	2.7	3.1	3.4	3.5	3.2	3.4	3.4	3.2	2.8	2.9	2.8
60%	2.8	2.7	3.1	3.3	3.4	3.1	3.3	3.3	3.1	2.7	2.8	2.8
70%	2.7	2.6	3.0	3.2	3.3	3.0	3.2	3.2	3.1	2.6	2.7	2.7
80%	2.7	2.5	2.8	3.1	3.2	2.9	3.1	3.1	3.0	2.6	2.7	2.7
90%	2.6	2.5	2.7	3.0	2.9	2.8	3.0	3.0	2.9	2.5	2.6	2.6
Long Term												
Full Simulation Period ^b	2.8	2.8	3.3	3.7	3.8	3.5	3.6	3.5	3.3	2.9	2.9	2.9
Water Year Types^c												
Wet (32%)	2.9	2.9	3.6	4.4	4.4	4.1	4.1	4.0	3.7	3.3	2.9	3.0
Above Normal (16%)	2.8	2.7	3.2	3.8	3.9	3.4	3.6	3.5	3.2	2.9	2.7	2.7
Below Normal (13%)	2.8	2.7	3.1	3.3	3.5	3.0	3.3	3.3	3.1	2.6	2.8	2.8
Dry (24%)	2.7	2.7	3.0	3.2	3.3	3.2	3.2	3.2	3.1	2.6	3.0	2.8
Critical (15%)	2.9	2.9	3.2	3.2	3.3	3.1	3.1	3.2	3.2	3.0	3.1	3.1

Alternative 5

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3.1	3.1	3.9	4.4	4.5	4.4	4.4	4.4	3.9	3.5	3.2	3.2
20%	2.9	2.9	3.5	4.1	4.2	3.8	3.9	3.8	3.5	3.2	3.1	3.1
30%	2.9	2.9	3.4	3.7	3.9	3.5	3.7	3.7	3.3	3.1	3.0	3.0
40%	2.8	2.8	3.3	3.5	3.7	3.3	3.6	3.6	3.2	2.9	3.0	2.9
50%	2.8	2.7	3.1	3.4	3.5	3.2	3.5	3.5	3.1	2.8	2.9	2.8
60%	2.8	2.7	3.1	3.3	3.4	3.1	3.4	3.5	3.1	2.7	2.8	2.8
70%	2.7	2.6	3.0	3.2	3.3	3.0	3.3	3.4	3.1	2.6	2.7	2.7
80%	2.7	2.5	2.8	3.1	3.2	2.9	3.3	3.4	3.0	2.6	2.7	2.7
90%	2.6	2.5	2.7	3.0	2.9	2.8	3.2	3.3	2.9	2.4	2.6	2.6
Long Term												
Full Simulation Period ^b	2.8	2.8	3.3	3.7	3.7	3.5	3.6	3.7	3.3	2.9	2.9	2.9
Water Year Types^c												
Wet (32%)	2.9	2.9	3.6	4.4	4.4	4.1	4.1	4.0	3.7	3.3	2.9	3.0
Above Normal (16%)	2.8	2.8	3.2	3.8	3.9	3.4	3.6	3.6	3.2	2.9	2.7	2.7
Below Normal (13%)	2.8	2.7	3.1	3.3	3.5	3.0	3.4	3.5	3.1	2.6	2.8	2.8
Dry (24%)	2.7	2.7	3.0	3.2	3.3	3.2	3.4	3.5	3.0	2.6	3.0	2.8
Critical (15%)	2.9	2.9	3.2	3.2	3.3	3.1	3.3	3.4	3.1	3.0	3.1	3.0

Alternative 5 minus No Action Alternative

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0
30%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.2	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.2	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.2	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.3	0.0	-0.1	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0
Water Year Types^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.2	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.3	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.2	0.0	0.0	-0.1	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-41-1-4. Old River at Tracy Blvd, Monthly Averaged Daily Maximum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.0	3.0	3.7	4.2	4.7	4.5	4.2	4.1	4.2	3.5	3.3	3.1
20%	2.8	2.9	3.4	3.8	4.2	3.9	3.3	3.3	3.5	3.2	3.1	3.0
30%	2.8	2.8	3.2	3.4	3.8	3.5	3.1	3.1	3.3	3.1	3.1	3.0
40%	2.7	2.7	3.1	3.2	3.5	3.2	2.9	3.0	3.2	3.0	3.0	2.9
50%	2.7	2.6	3.0	3.1	3.3	3.1	2.9	2.9	3.1	2.9	2.9	2.8
60%	2.6	2.6	2.9	3.0	3.1	3.0	2.8	2.8	3.0	2.8	2.8	2.8
70%	2.5	2.5	2.9	2.9	3.0	2.9	2.7	2.7	2.9	2.7	2.8	2.7
80%	2.5	2.5	2.8	2.9	2.8	2.7	2.7	2.6	2.8	2.7	2.7	2.6
90%	2.4	2.4	2.7	2.8	2.6	2.6	2.6	2.5	2.7	2.6	2.6	2.6
Long Term												
Full Simulation Period ^b	2.7	2.7	3.2	3.4	3.6	3.4	3.1	3.1	3.3	3.0	2.9	2.9
Water Year Types ^c												
Wet (32%)	2.7	2.8	3.5	4.2	4.3	4.2	3.7	3.5	3.9	3.3	3.0	2.9
Above Normal (16%)	2.7	2.7	3.1	3.4	3.7	3.3	2.9	2.9	3.1	2.9	2.7	2.6
Below Normal (13%)	2.6	2.6	3.0	3.0	3.4	2.9	2.8	2.7	2.9	2.6	2.9	2.8
Dry (24%)	2.6	2.6	2.9	3.0	3.0	3.0	2.8	2.8	3.0	2.8	3.0	2.8
Critical (15%)	2.8	2.8	3.1	3.1	3.1	2.9	2.9	3.0	3.0	3.1	3.1	3.1

No Action Alternative

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.1	3.1	3.9	4.4	4.5	4.4	4.4	4.4	3.9	3.5	3.3	3.2
20%	2.9	2.9	3.5	4.1	4.2	3.8	3.9	3.8	3.5	3.2	3.1	3.1
30%	2.9	2.9	3.4	3.7	3.9	3.5	3.6	3.6	3.3	3.1	3.1	3.0
40%	2.9	2.8	3.3	3.5	3.7	3.3	3.5	3.5	3.2	3.0	3.0	2.9
50%	2.8	2.7	3.1	3.4	3.5	3.2	3.4	3.4	3.2	2.8	2.9	2.8
60%	2.8	2.7	3.1	3.3	3.4	3.1	3.3	3.3	3.1	2.7	2.8	2.8
70%	2.7	2.6	3.0	3.2	3.3	3.0	3.2	3.2	3.1	2.6	2.7	2.7
80%	2.7	2.5	2.8	3.1	3.2	2.9	3.1	3.1	3.0	2.6	2.7	2.7
90%	2.6	2.5	2.7	3.0	2.9	2.8	3.0	3.0	2.9	2.5	2.6	2.6
Long Term												
Full Simulation Period ^b	2.8	2.8	3.3	3.7	3.8	3.5	3.6	3.5	3.3	2.9	2.9	2.9
Water Year Types ^c												
Wet (32%)	2.9	2.9	3.6	4.4	4.4	4.1	4.1	4.0	3.7	3.3	2.9	3.0
Above Normal (16%)	2.8	2.7	3.2	3.8	3.9	3.4	3.6	3.5	3.2	2.9	2.7	2.7
Below Normal (13%)	2.8	2.7	3.1	3.3	3.5	3.0	3.3	3.3	3.1	2.6	2.8	2.8
Dry (24%)	2.7	2.7	3.0	3.2	3.3	3.2	3.2	3.2	3.1	2.6	3.0	2.8
Critical (15%)	2.9	2.9	3.2	3.2	3.3	3.1	3.1	3.2	3.2	3.0	3.1	3.1

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.1	0.1	0.1	0.2	-0.2	-0.1	0.1	0.3	-0.3	0.0	0.0	0.1
20%	0.1	0.1	0.1	0.3	0.0	-0.1	0.6	0.5	0.0	0.0	0.0	0.1
30%	0.1	0.1	0.1	0.3	0.1	0.0	0.5	0.5	0.0	0.0	0.0	0.0
40%	0.1	0.1	0.1	0.3	0.3	0.1	0.6	0.5	0.1	0.0	0.0	0.0
50%	0.1	0.1	0.1	0.3	0.2	0.1	0.5	0.5	0.1	0.0	0.0	0.0
60%	0.1	0.1	0.1	0.3	0.3	0.1	0.5	0.5	0.1	-0.1	0.0	0.0
70%	0.2	0.1	0.1	0.3	0.3	0.1	0.5	0.5	0.2	-0.1	0.0	0.0
80%	0.2	0.1	0.0	0.3	0.3	0.2	0.5	0.5	0.2	-0.1	0.0	0.0
90%	0.2	0.1	0.0	0.2	0.3	0.2	0.4	0.5	0.2	-0.1	-0.1	0.1
Long Term												
Full Simulation Period ^b	0.1	0.1	0.1	0.2	0.2	0.1	0.4	0.5	0.0	-0.1	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.2	0.1	0.1	0.2	0.1	0.0	0.4	0.5	-0.1	0.0	0.0	0.1
Above Normal (16%)	0.1	0.1	0.1	0.4	0.2	0.0	0.7	0.7	0.1	0.0	-0.1	0.1
Below Normal (13%)	0.2	0.2	0.0	0.3	0.1	0.1	0.5	0.6	0.2	0.0	-0.1	0.0
Dry (24%)	0.1	0.1	0.0	0.2	0.3	0.2	0.4	0.4	0.1	-0.1	0.0	0.0
Critical (15%)	0.1	0.1	0.1	0.1	0.2	0.1	0.2	0.2	0.1	-0.1	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-41-1-5. Old River at Tracy Blvd, Monthly Averaged Daily Maximum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.0	3.0	3.7	4.2	4.7	4.5	4.2	4.1	4.2	3.5	3.3	3.1
20%	2.8	2.9	3.4	3.8	4.2	3.9	3.3	3.3	3.5	3.2	3.1	3.0
30%	2.8	2.8	3.2	3.4	3.8	3.5	3.1	3.1	3.3	3.1	3.1	3.0
40%	2.7	2.7	3.1	3.2	3.5	3.2	2.9	3.0	3.2	3.0	3.0	2.9
50%	2.7	2.6	3.0	3.1	3.3	3.1	2.9	2.9	3.1	2.9	2.9	2.8
60%	2.6	2.6	2.9	3.0	3.1	3.0	2.8	2.8	3.0	2.8	2.8	2.8
70%	2.5	2.5	2.9	2.9	3.0	2.9	2.7	2.7	2.9	2.7	2.8	2.7
80%	2.5	2.5	2.8	2.9	2.8	2.7	2.7	2.6	2.8	2.7	2.7	2.6
90%	2.4	2.4	2.7	2.8	2.6	2.6	2.6	2.5	2.7	2.6	2.6	2.6
Long Term												
Full Simulation Period ^b	2.7	2.7	3.2	3.4	3.6	3.4	3.1	3.1	3.3	3.0	2.9	2.9
Water Year Types ^c												
Wet (32%)	2.7	2.8	3.5	4.2	4.3	4.2	3.7	3.5	3.9	3.3	3.0	2.9
Above Normal (16%)	2.7	2.7	3.1	3.4	3.7	3.3	2.9	2.9	3.1	2.9	2.7	2.6
Below Normal (13%)	2.6	2.6	3.0	3.0	3.4	2.9	2.8	2.7	2.9	2.6	2.9	2.8
Dry (24%)	2.6	2.6	2.9	3.0	3.0	3.0	2.8	2.8	3.0	2.8	3.0	2.8
Critical (15%)	2.8	2.8	3.1	3.1	3.1	2.9	2.9	3.0	3.0	3.1	3.1	3.1

Alternative 3

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.0	3.0	3.8	4.4	4.7	4.6	4.2	4.0	3.8	3.6	3.3	3.2
20%	2.9	2.8	3.5	4.2	4.2	3.8	3.6	3.4	3.4	3.2	3.2	3.1
30%	2.8	2.8	3.3	3.7	3.9	3.5	3.3	3.2	3.2	3.1	3.1	3.0
40%	2.7	2.7	3.2	3.5	3.7	3.4	3.2	3.2	3.1	2.9	3.0	2.9
50%	2.7	2.6	3.1	3.4	3.5	3.2	3.1	3.1	3.0	2.9	2.9	2.8
60%	2.6	2.6	3.0	3.3	3.4	3.1	3.0	3.0	2.9	2.8	2.8	2.8
70%	2.6	2.5	2.9	3.2	3.2	3.0	3.0	3.0	2.8	2.7	2.7	2.7
80%	2.4	2.4	2.9	3.1	3.1	2.9	2.9	2.9	2.8	2.6	2.6	2.6
90%	2.4	2.4	2.8	3.0	2.9	2.7	2.8	2.8	2.7	2.5	2.6	2.6
Long Term												
Full Simulation Period ^b	2.7	2.7	3.3	3.7	3.7	3.4	3.3	3.2	3.2	3.0	2.9	2.9
Water Year Types ^c												
Wet (32%)	2.7	2.8	3.6	4.4	4.4	4.1	3.8	3.6	3.6	3.3	3.0	2.9
Above Normal (16%)	2.7	2.7	3.2	3.8	3.9	3.3	3.2	3.1	3.0	2.8	2.7	2.6
Below Normal (13%)	2.6	2.6	3.1	3.3	3.5	2.9	3.1	3.0	2.9	2.6	2.7	2.8
Dry (24%)	2.6	2.6	3.0	3.2	3.3	3.1	3.0	3.0	2.9	2.7	3.0	2.8
Critical (15%)	2.9	2.8	3.2	3.2	3.3	3.1	3.1	3.2	3.0	3.1	3.1	3.1

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.0	0.1	0.2	0.0	0.0	0.0	-0.1	-0.3	0.1	0.0	0.0
20%	0.0	0.0	0.1	0.4	0.0	-0.1	0.3	0.2	-0.2	0.0	0.0	0.0
30%	0.0	0.0	0.1	0.3	0.1	0.0	0.2	0.1	-0.1	0.0	0.0	0.0
40%	0.0	0.0	0.1	0.2	0.3	0.1	0.3	0.1	-0.1	-0.1	0.0	0.0
50%	0.0	0.0	0.1	0.3	0.2	0.0	0.2	0.1	-0.1	0.0	0.0	0.0
60%	0.0	0.0	0.1	0.3	0.2	0.1	0.2	0.2	-0.1	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.3	0.3	0.1	0.3	0.3	-0.1	0.0	-0.1	0.0
80%	0.0	0.0	0.1	0.2	0.3	0.1	0.2	0.3	-0.1	-0.1	-0.1	0.0
90%	0.0	0.0	0.1	0.2	0.2	0.1	0.2	0.2	0.0	-0.1	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.1	0.2	0.2	0.0	0.2	0.2	-0.1	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.1	0.2	0.1	0.0	0.1	0.1	-0.3	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.1	0.4	0.2	0.0	0.3	0.2	-0.1	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.3	0.2	0.1	0.3	0.3	0.0	0.0	-0.1	-0.1
Dry (24%)	0.0	0.0	0.0	0.2	0.3	0.2	0.2	0.2	-0.1	-0.1	0.0	0.0
Critical (15%)	0.0	0.0	0.1	0.1	0.2	0.1	0.2	0.2	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-41-1-6. Old River at Tracy Blvd, Monthly Averaged Daily Maximum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.0	3.0	3.7	4.2	4.7	4.5	4.2	4.1	4.2	3.5	3.3	3.1
20%	2.8	2.9	3.4	3.8	4.2	3.9	3.3	3.3	3.5	3.2	3.1	3.0
30%	2.8	2.8	3.2	3.4	3.8	3.5	3.1	3.1	3.3	3.1	3.1	3.0
40%	2.7	2.7	3.1	3.2	3.5	3.2	2.9	3.0	3.2	3.0	3.0	2.9
50%	2.7	2.6	3.0	3.1	3.3	3.1	2.9	2.9	3.1	2.9	2.9	2.8
60%	2.6	2.6	2.9	3.0	3.1	3.0	2.8	2.8	3.0	2.8	2.8	2.8
70%	2.5	2.5	2.9	2.9	3.0	2.9	2.7	2.7	2.9	2.7	2.8	2.7
80%	2.5	2.5	2.8	2.9	2.8	2.7	2.7	2.6	2.8	2.7	2.7	2.6
90%	2.4	2.4	2.7	2.8	2.6	2.6	2.6	2.5	2.7	2.6	2.6	2.6
Long Term												
Full Simulation Period ^b	2.7	2.7	3.2	3.4	3.6	3.4	3.1	3.1	3.3	3.0	2.9	2.9
Water Year Types ^c												
Wet (32%)	2.7	2.8	3.5	4.2	4.3	4.2	3.7	3.5	3.9	3.3	3.0	2.9
Above Normal (16%)	2.7	2.7	3.1	3.4	3.7	3.3	2.9	2.9	3.1	2.9	2.7	2.6
Below Normal (13%)	2.6	2.6	3.0	3.0	3.4	2.9	2.8	2.7	2.9	2.6	2.9	2.8
Dry (24%)	2.6	2.6	2.9	3.0	3.0	3.0	2.8	2.8	3.0	2.8	3.0	2.8
Critical (15%)	2.8	2.8	3.1	3.1	3.1	2.9	2.9	3.0	3.0	3.1	3.1	3.1

Alternative 5

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.1	3.1	3.9	4.4	4.5	4.4	4.4	4.4	3.9	3.5	3.2	3.2
20%	2.9	2.9	3.5	4.1	4.2	3.8	3.9	3.8	3.5	3.2	3.1	3.1
30%	2.9	2.9	3.4	3.7	3.9	3.5	3.7	3.7	3.3	3.1	3.0	3.0
40%	2.8	2.8	3.3	3.5	3.7	3.3	3.6	3.6	3.2	2.9	3.0	2.9
50%	2.8	2.7	3.1	3.4	3.5	3.2	3.5	3.5	3.1	2.8	2.9	2.8
60%	2.8	2.7	3.1	3.3	3.4	3.1	3.4	3.5	3.1	2.7	2.8	2.8
70%	2.7	2.6	3.0	3.2	3.3	3.0	3.3	3.4	3.1	2.6	2.7	2.7
80%	2.7	2.5	2.8	3.1	3.2	2.9	3.3	3.4	3.0	2.6	2.7	2.7
90%	2.6	2.5	2.7	3.0	2.9	2.8	3.2	3.3	2.9	2.4	2.6	2.6
Long Term												
Full Simulation Period ^b	2.8	2.8	3.3	3.7	3.7	3.5	3.6	3.7	3.3	2.9	2.9	2.9
Water Year Types ^c												
Wet (32%)	2.9	2.9	3.6	4.4	4.4	4.1	4.1	4.0	3.7	3.3	2.9	3.0
Above Normal (16%)	2.8	2.8	3.2	3.8	3.9	3.4	3.6	3.6	3.2	2.9	2.7	2.7
Below Normal (13%)	2.8	2.7	3.1	3.3	3.5	3.0	3.4	3.5	3.1	2.6	2.8	2.8
Dry (24%)	2.7	2.7	3.0	3.2	3.3	3.2	3.4	3.5	3.0	2.6	3.0	2.8
Critical (15%)	2.9	2.9	3.2	3.2	3.3	3.1	3.3	3.4	3.1	3.0	3.1	3.0

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.1	0.1	0.1	0.2	-0.2	-0.1	0.1	0.2	-0.3	0.0	-0.1	0.0
20%	0.1	0.1	0.1	0.3	0.0	-0.1	0.6	0.5	-0.1	0.0	0.0	0.0
30%	0.1	0.1	0.1	0.3	0.1	0.0	0.6	0.6	0.0	0.0	0.0	0.0
40%	0.1	0.1	0.1	0.3	0.3	0.1	0.6	0.6	0.1	-0.1	0.0	0.1
50%	0.1	0.1	0.1	0.3	0.2	0.1	0.6	0.6	0.0	0.0	0.0	0.0
60%	0.2	0.1	0.1	0.3	0.3	0.1	0.6	0.7	0.1	-0.1	-0.1	0.0
70%	0.2	0.1	0.1	0.3	0.3	0.1	0.6	0.7	0.2	-0.1	-0.1	0.0
80%	0.2	0.1	0.0	0.2	0.3	0.2	0.6	0.8	0.2	-0.1	0.0	0.0
90%	0.2	0.1	0.0	0.2	0.3	0.2	0.6	0.8	0.2	-0.2	-0.1	0.0
Long Term												
Full Simulation Period ^b	0.1	0.1	0.1	0.2	0.2	0.1	0.5	0.6	0.0	-0.1	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.2	0.1	0.1	0.2	0.1	0.0	0.4	0.5	-0.1	0.0	-0.1	0.1
Above Normal (16%)	0.1	0.1	0.1	0.3	0.2	0.0	0.7	0.8	0.1	0.0	0.0	0.1
Below Normal (13%)	0.2	0.2	0.0	0.3	0.1	0.1	0.6	0.8	0.3	0.0	-0.1	0.0
Dry (24%)	0.1	0.1	0.0	0.2	0.3	0.2	0.6	0.6	0.1	-0.2	0.0	0.0
Critical (15%)	0.1	0.1	0.1	0.1	0.2	0.1	0.4	0.5	0.1	-0.2	0.0	0.0


a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-41-2-1. Old River at Tracy Blvd, Monthly Averaged Daily Minimum Elevation, October

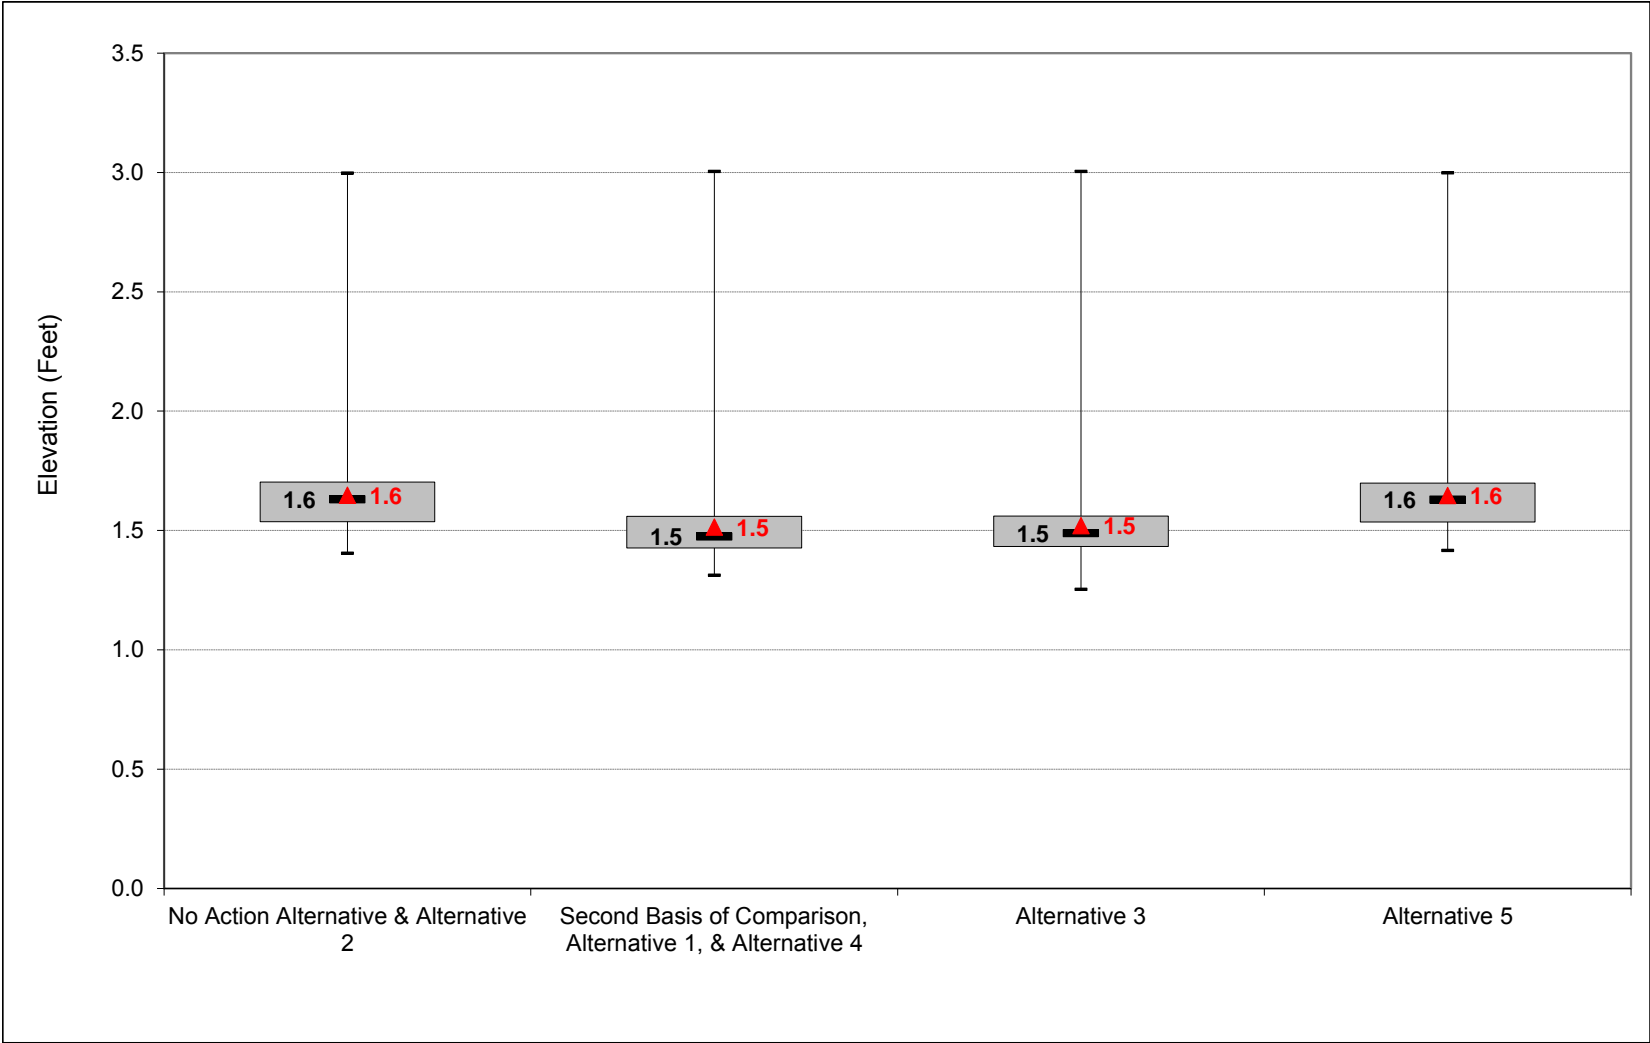


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-41-2-2. Old River at Tracy Blvd, Monthly Averaged Daily Minimum Elevation, November

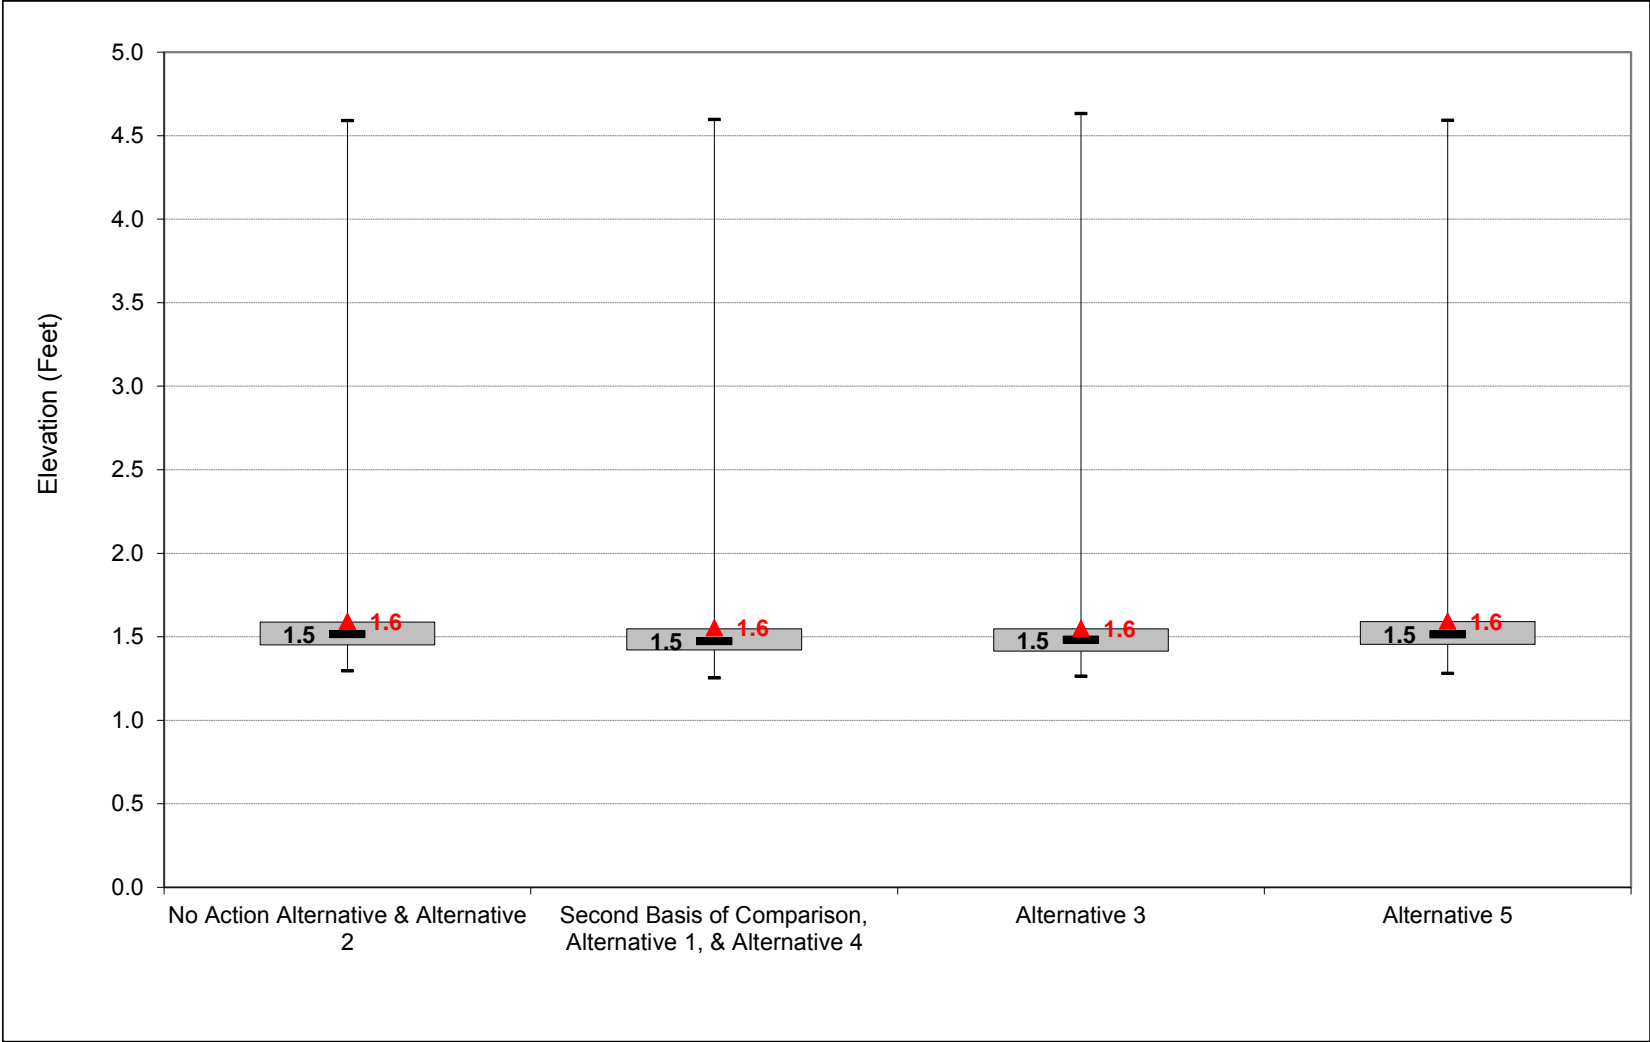


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-41-2-3. Old River at Tracy Blvd, Monthly Averaged Daily Minimum Elevation, December

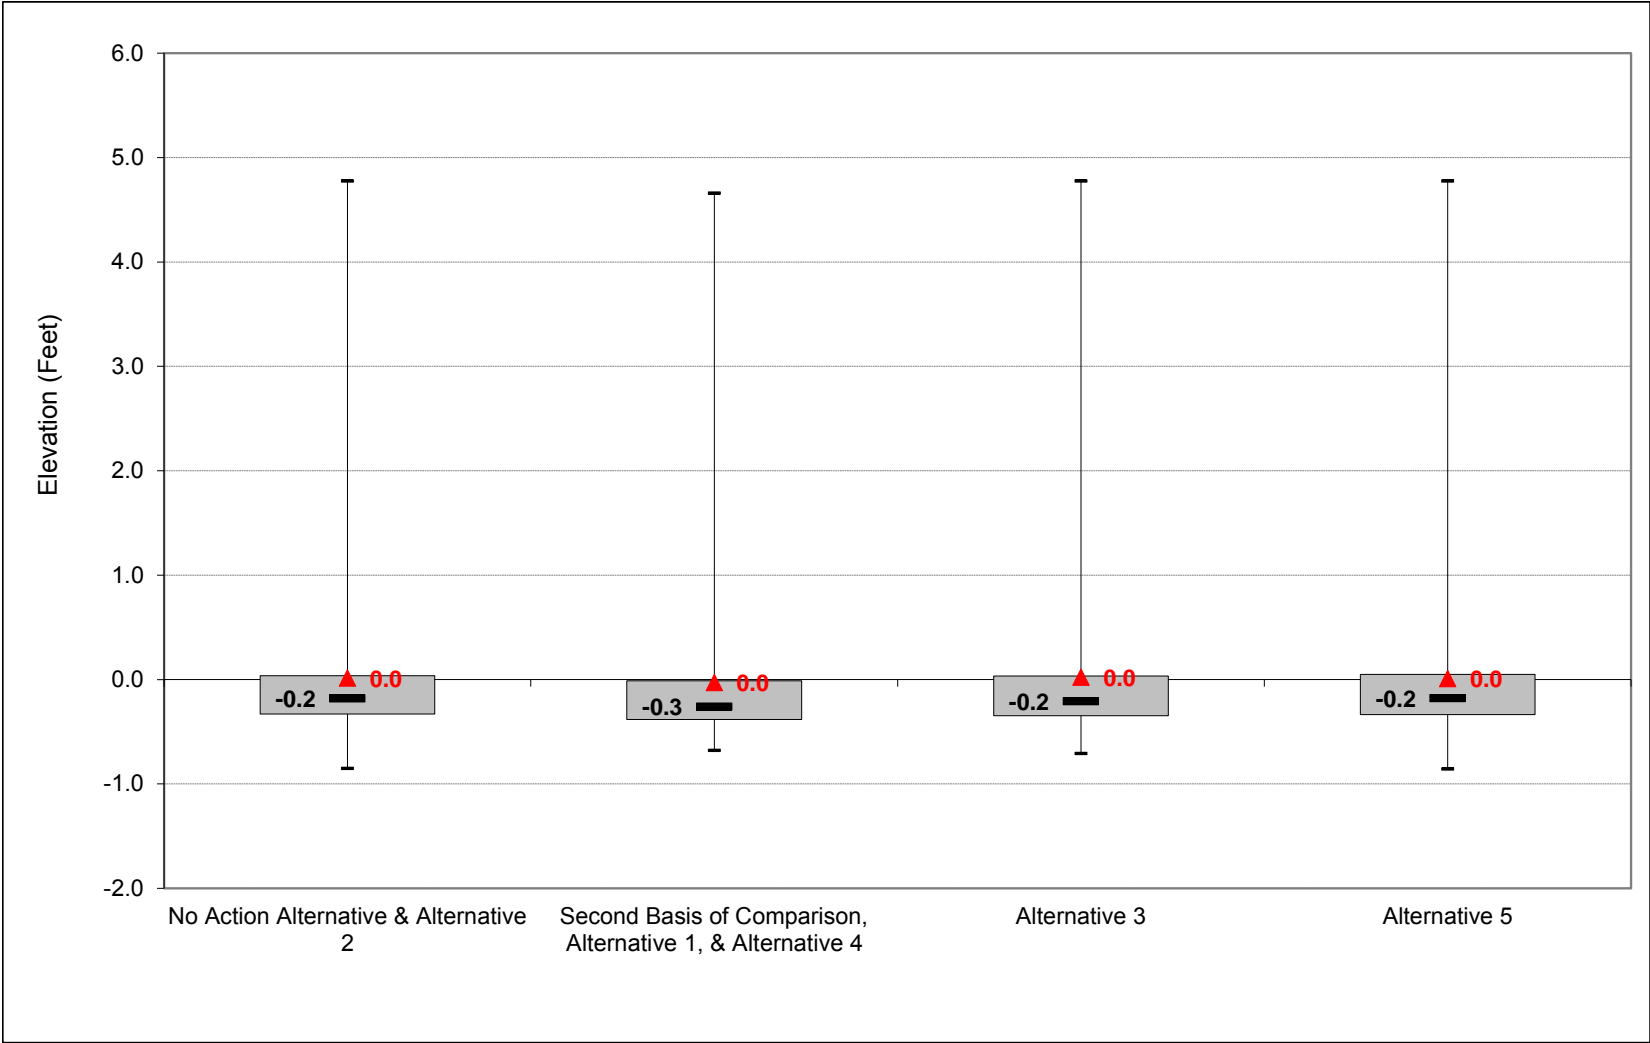


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-41-2-4. Old River at Tracy Blvd, Monthly Averaged Daily Minimum Elevation, January

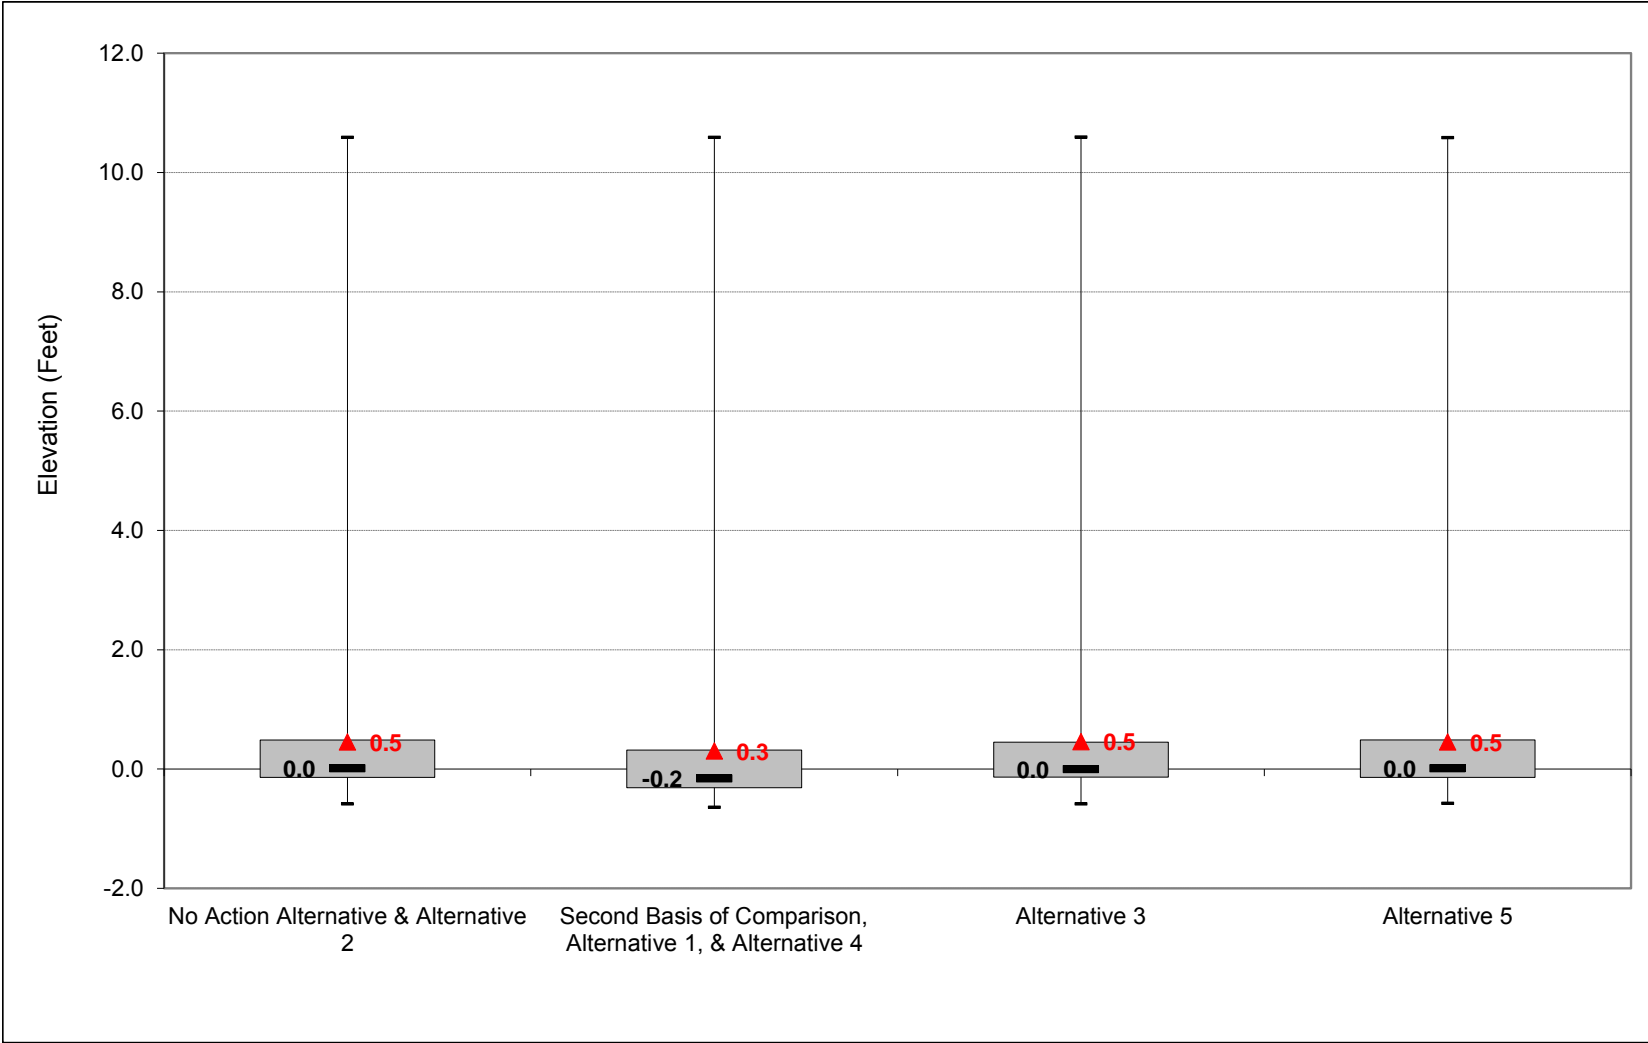


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-41-2-5. Old River at Tracy Blvd, Monthly Averaged Daily Minimum Elevation, February

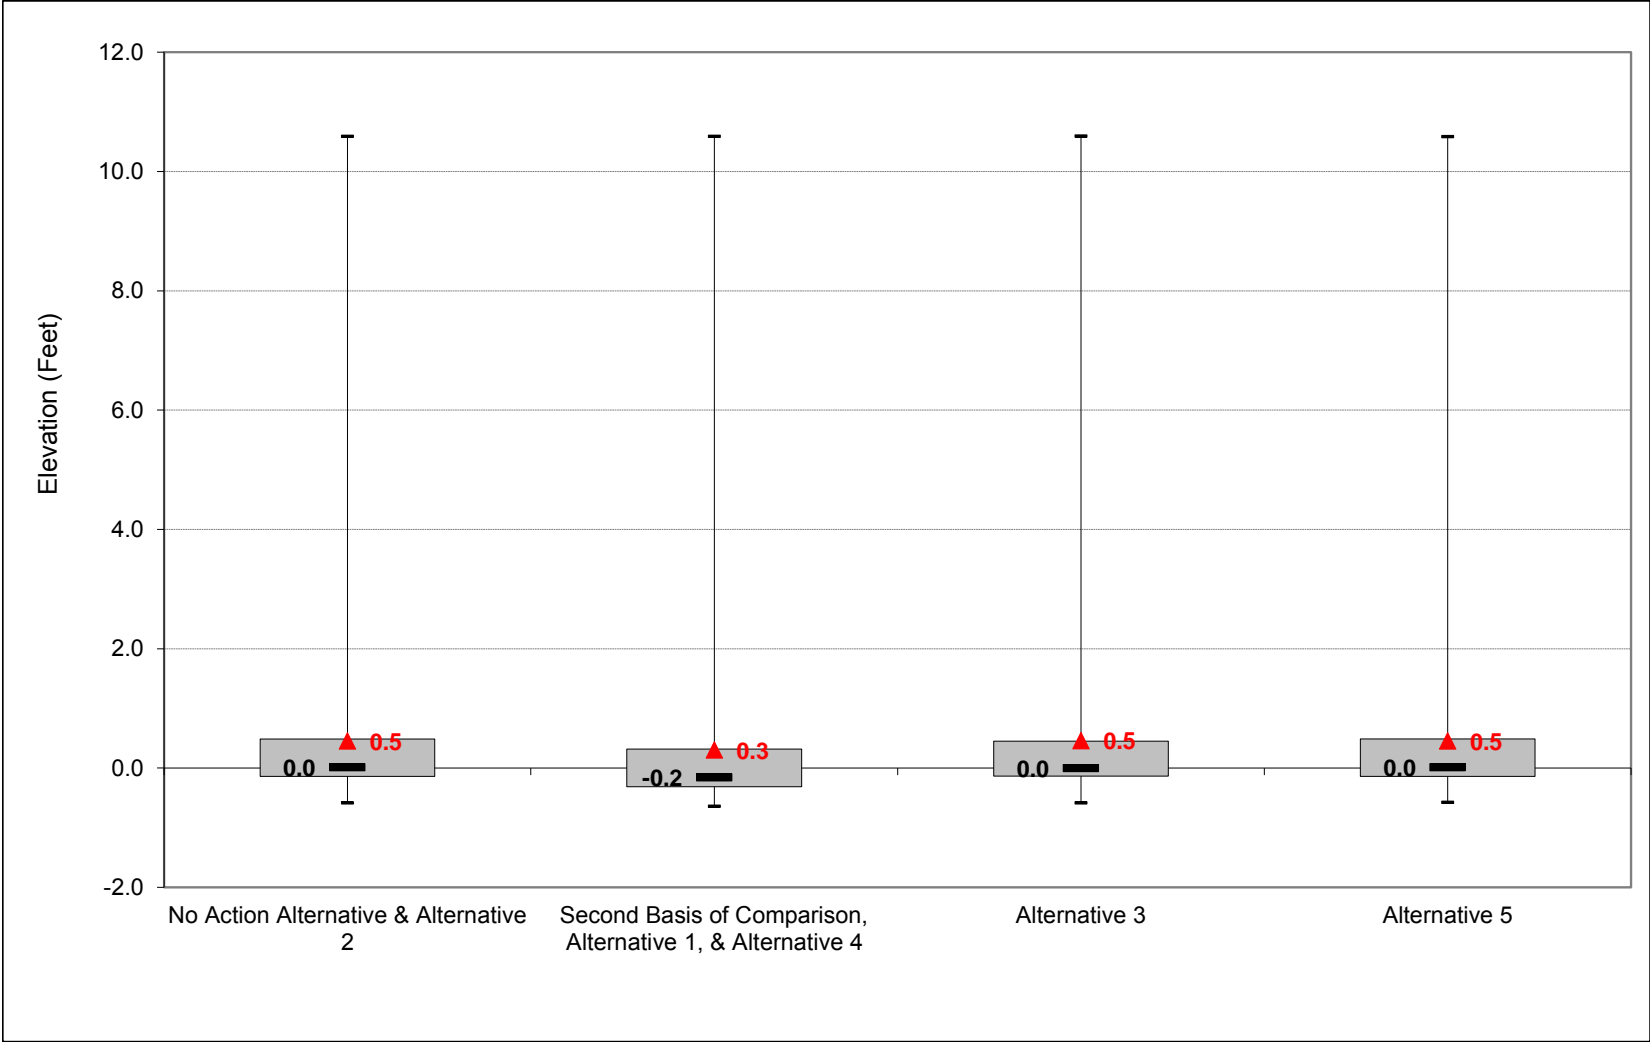


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-41-2-6. Old River at Tracy Blvd, Monthly Averaged Daily Minimum Elevation, March

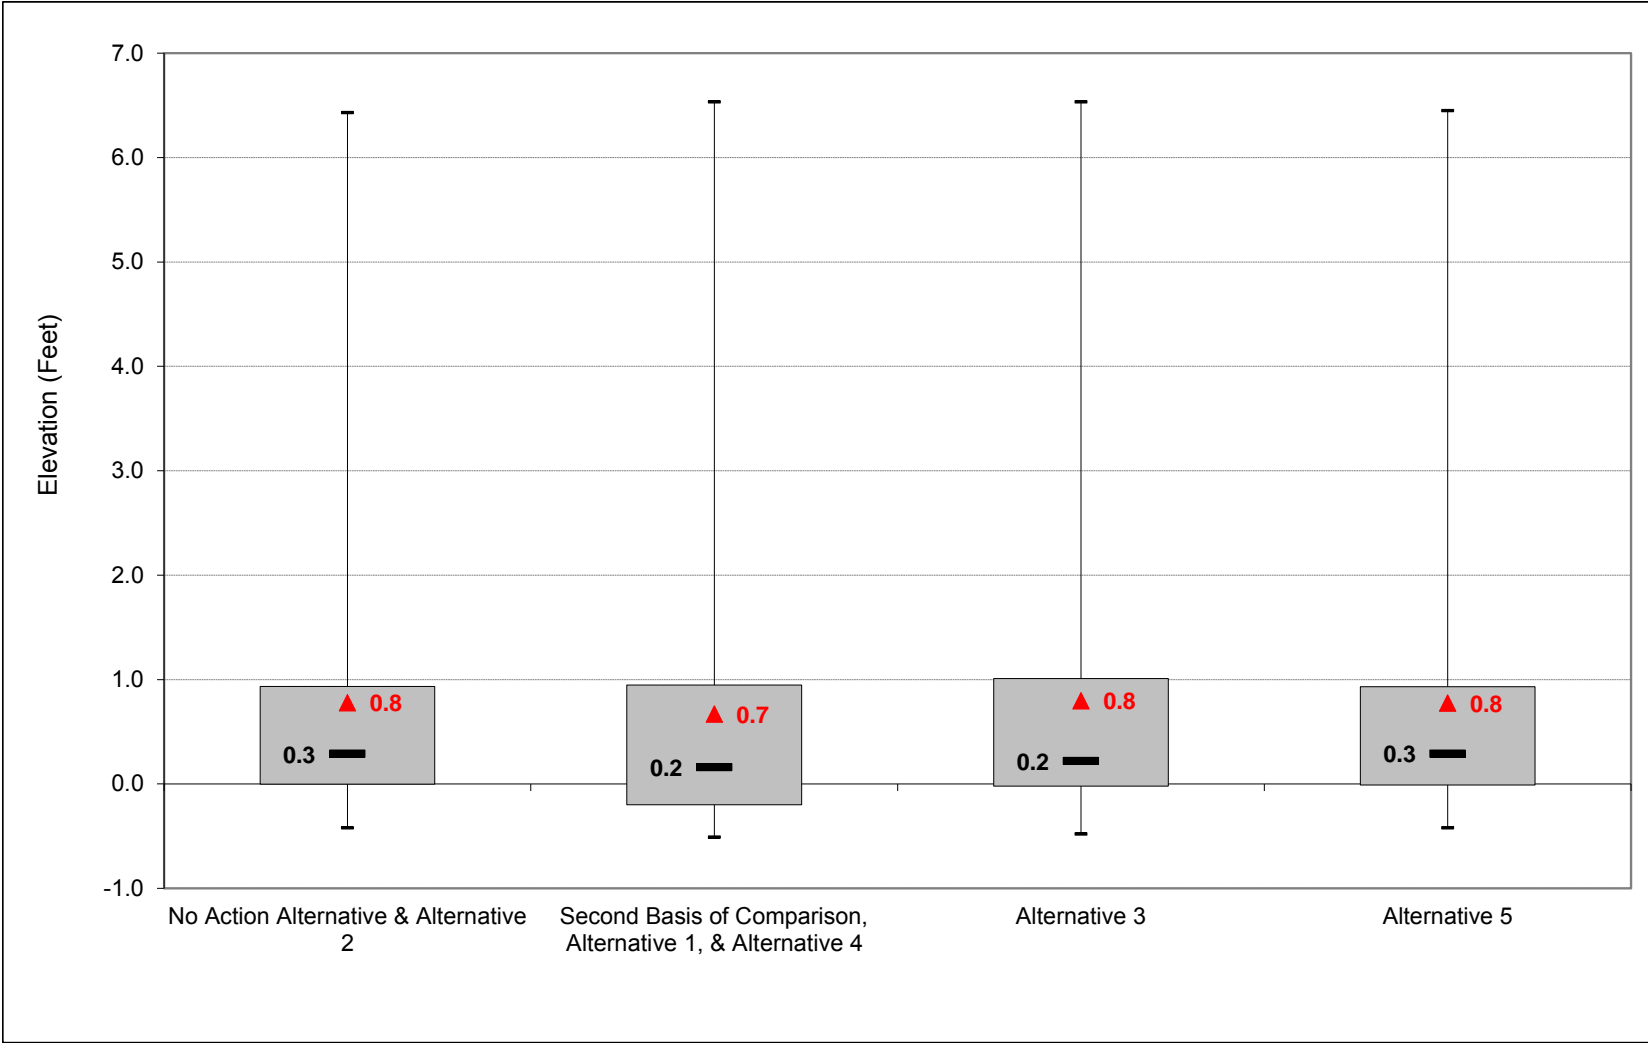


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-41-2-7. Old River at Tracy Blvd, Monthly Averaged Daily Minimum Elevation, April

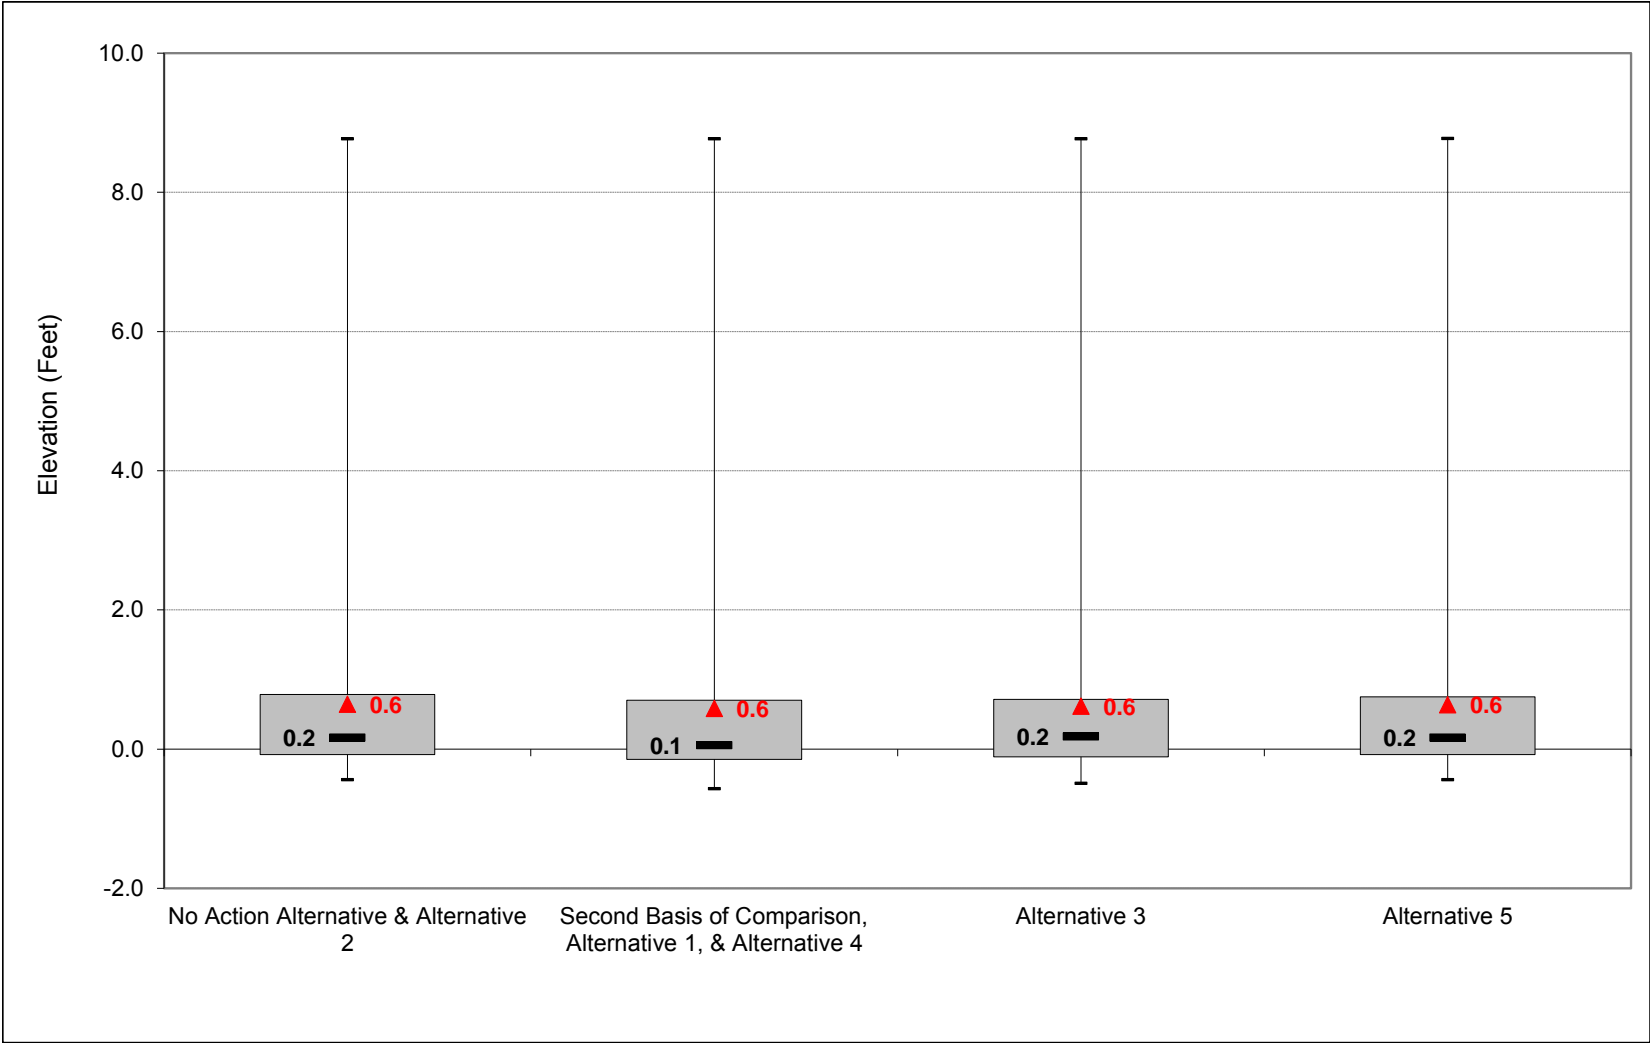


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-41-2-8. Old River at Tracy Blvd, Monthly Averaged Daily Minimum Elevation, May

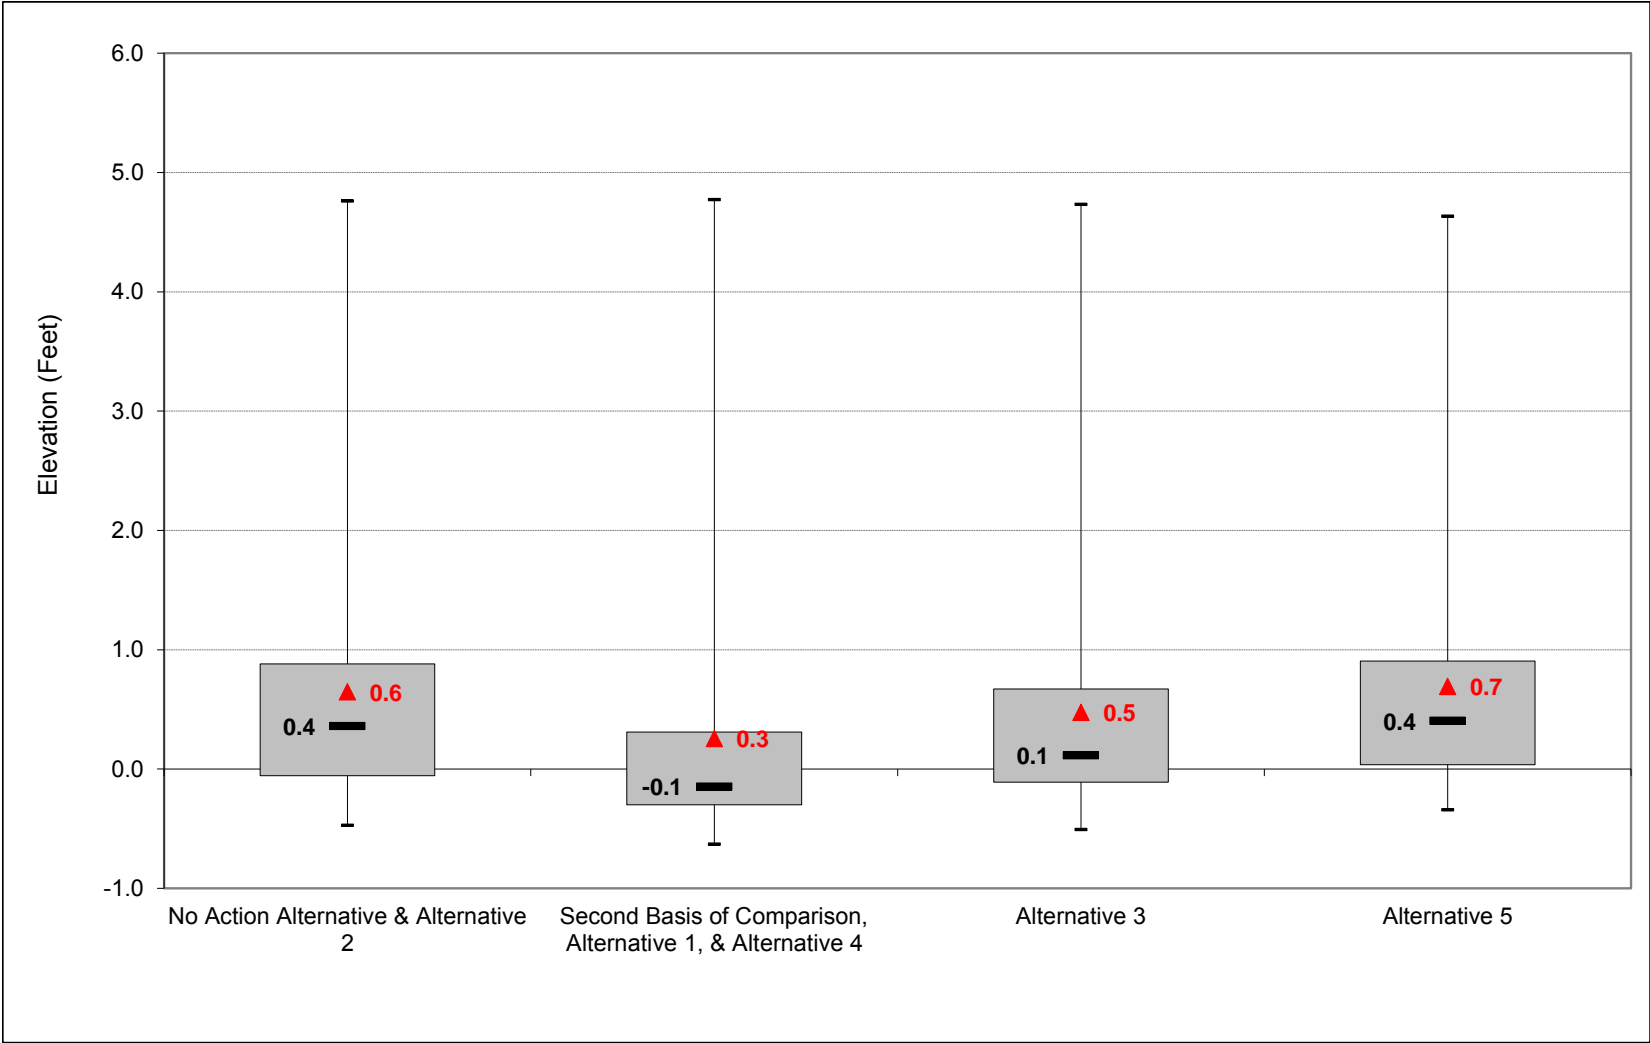


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-41-2-9. Old River at Tracy Blvd, Monthly Averaged Daily Minimum Elevation, June

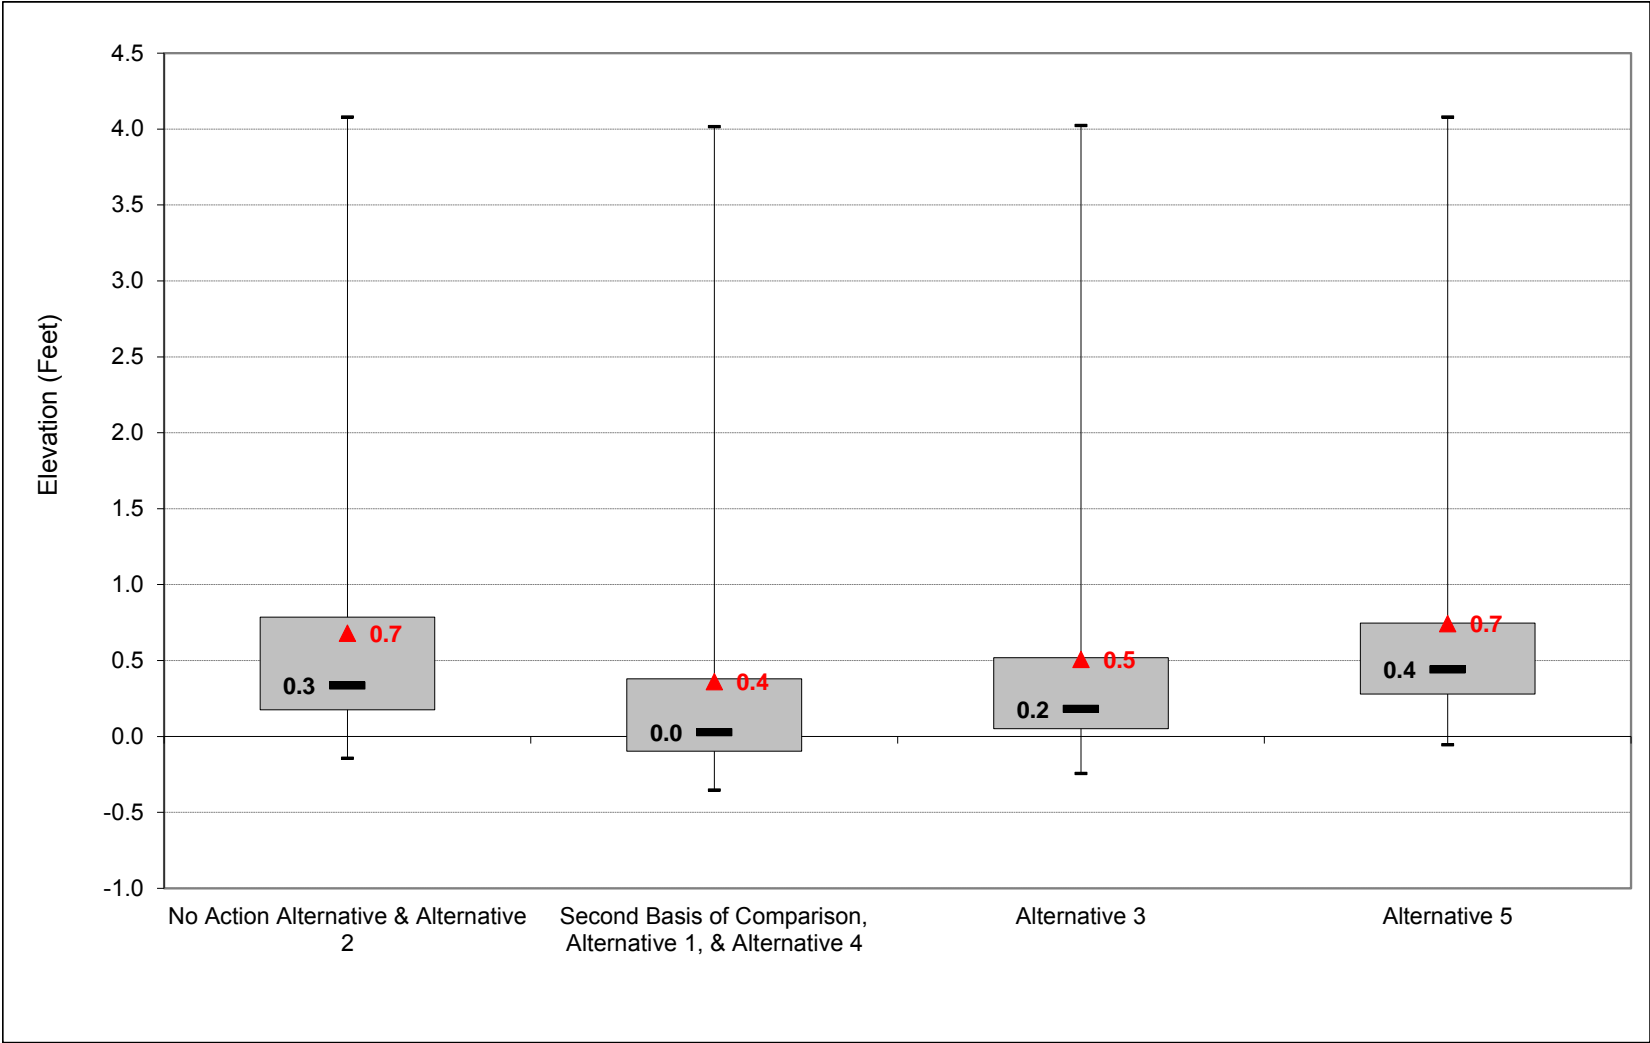


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-41-2-10. Old River at Tracy Blvd, Monthly Averaged Daily Minimum Elevation, July

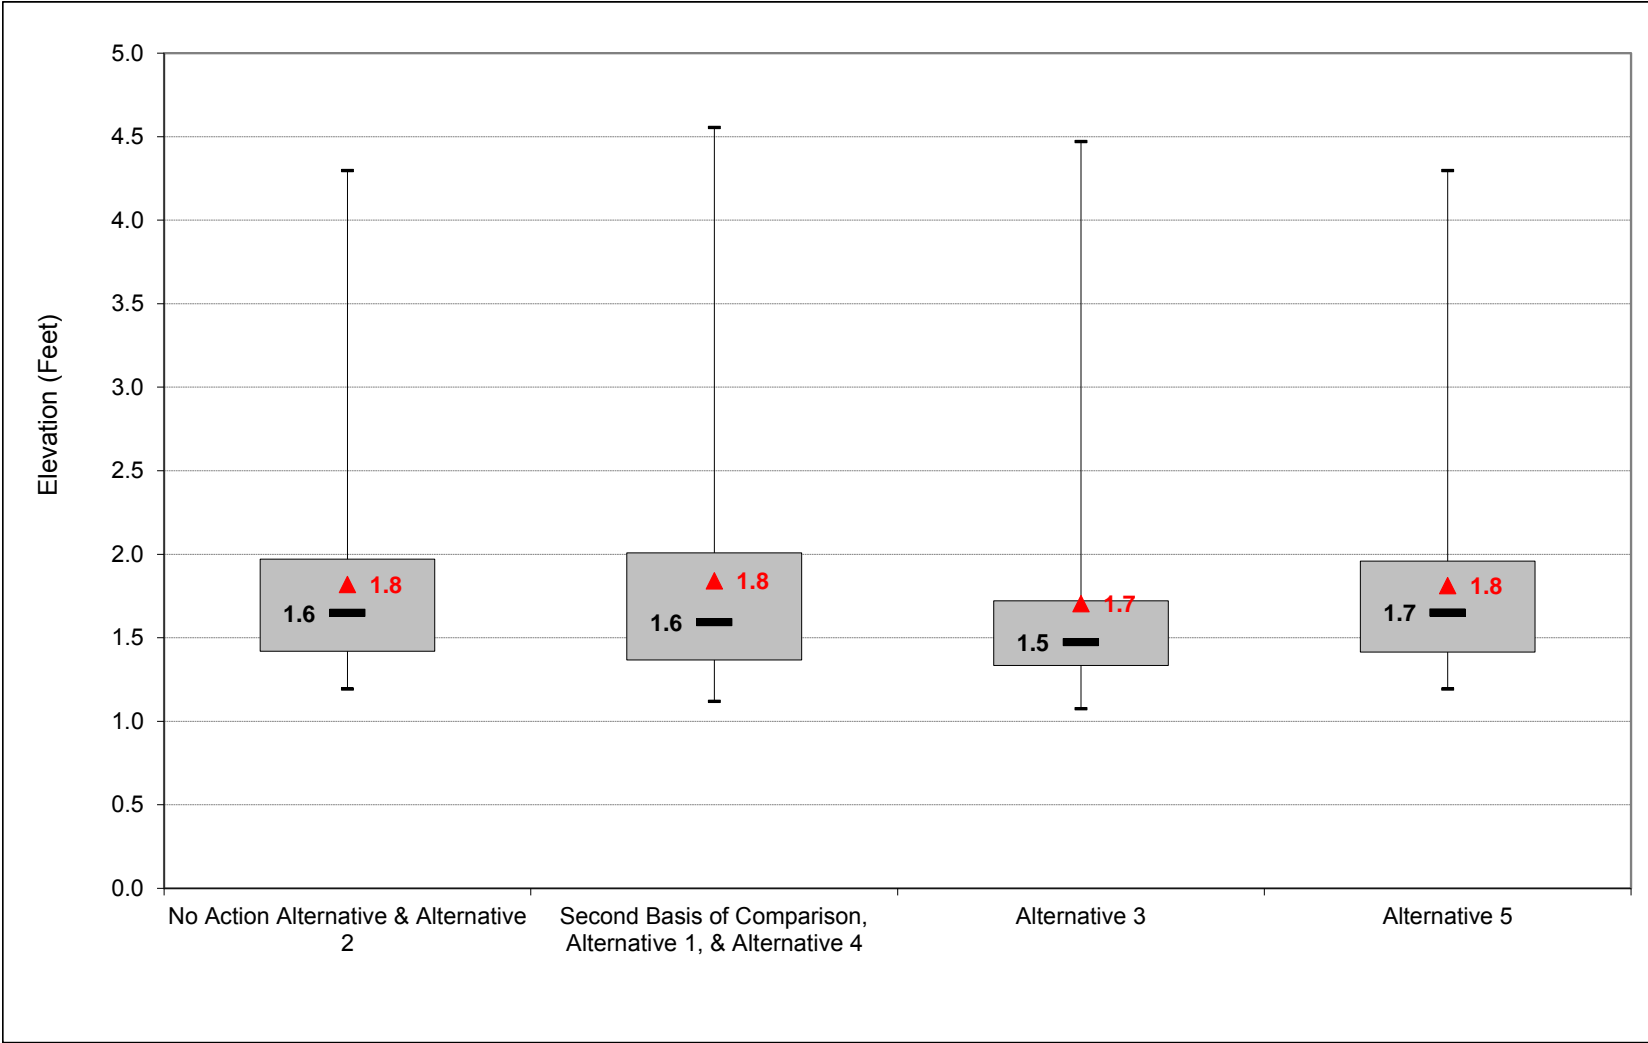


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-41-2-11. Old River at Tracy Blvd, Monthly Averaged Daily Minimum Elevation, August

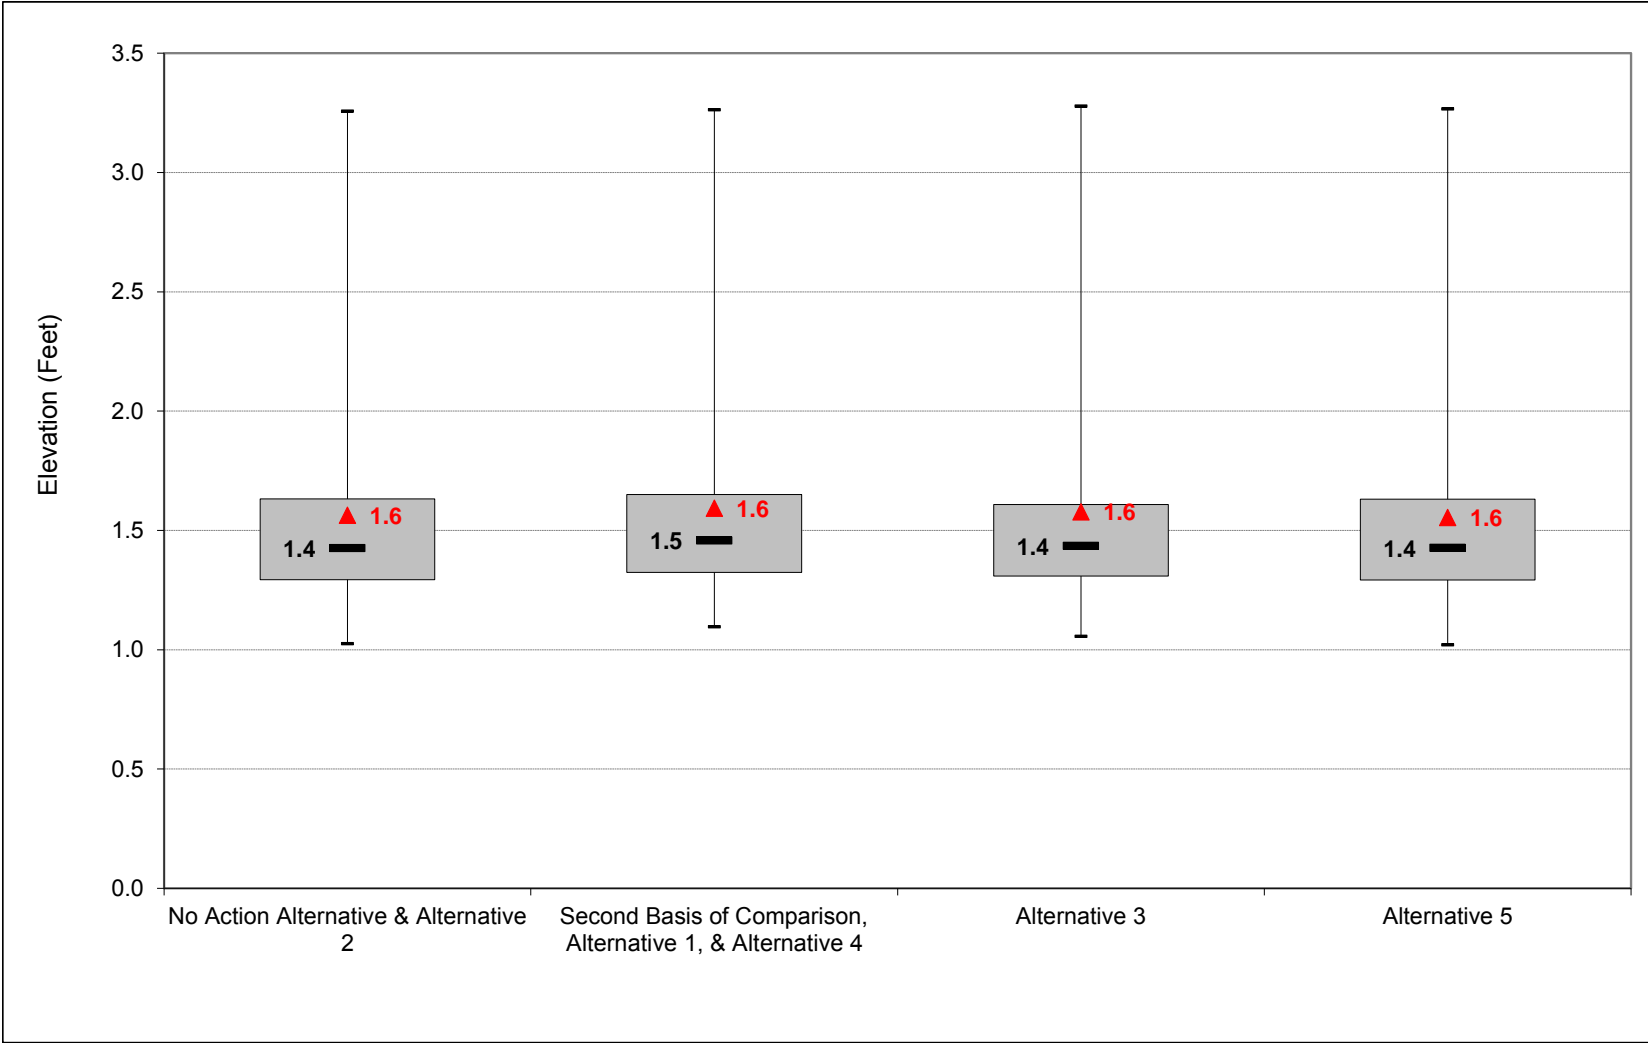

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-41-2-12. Old River at Tracy Blvd, Monthly Averaged Daily Minimum Elevation, September

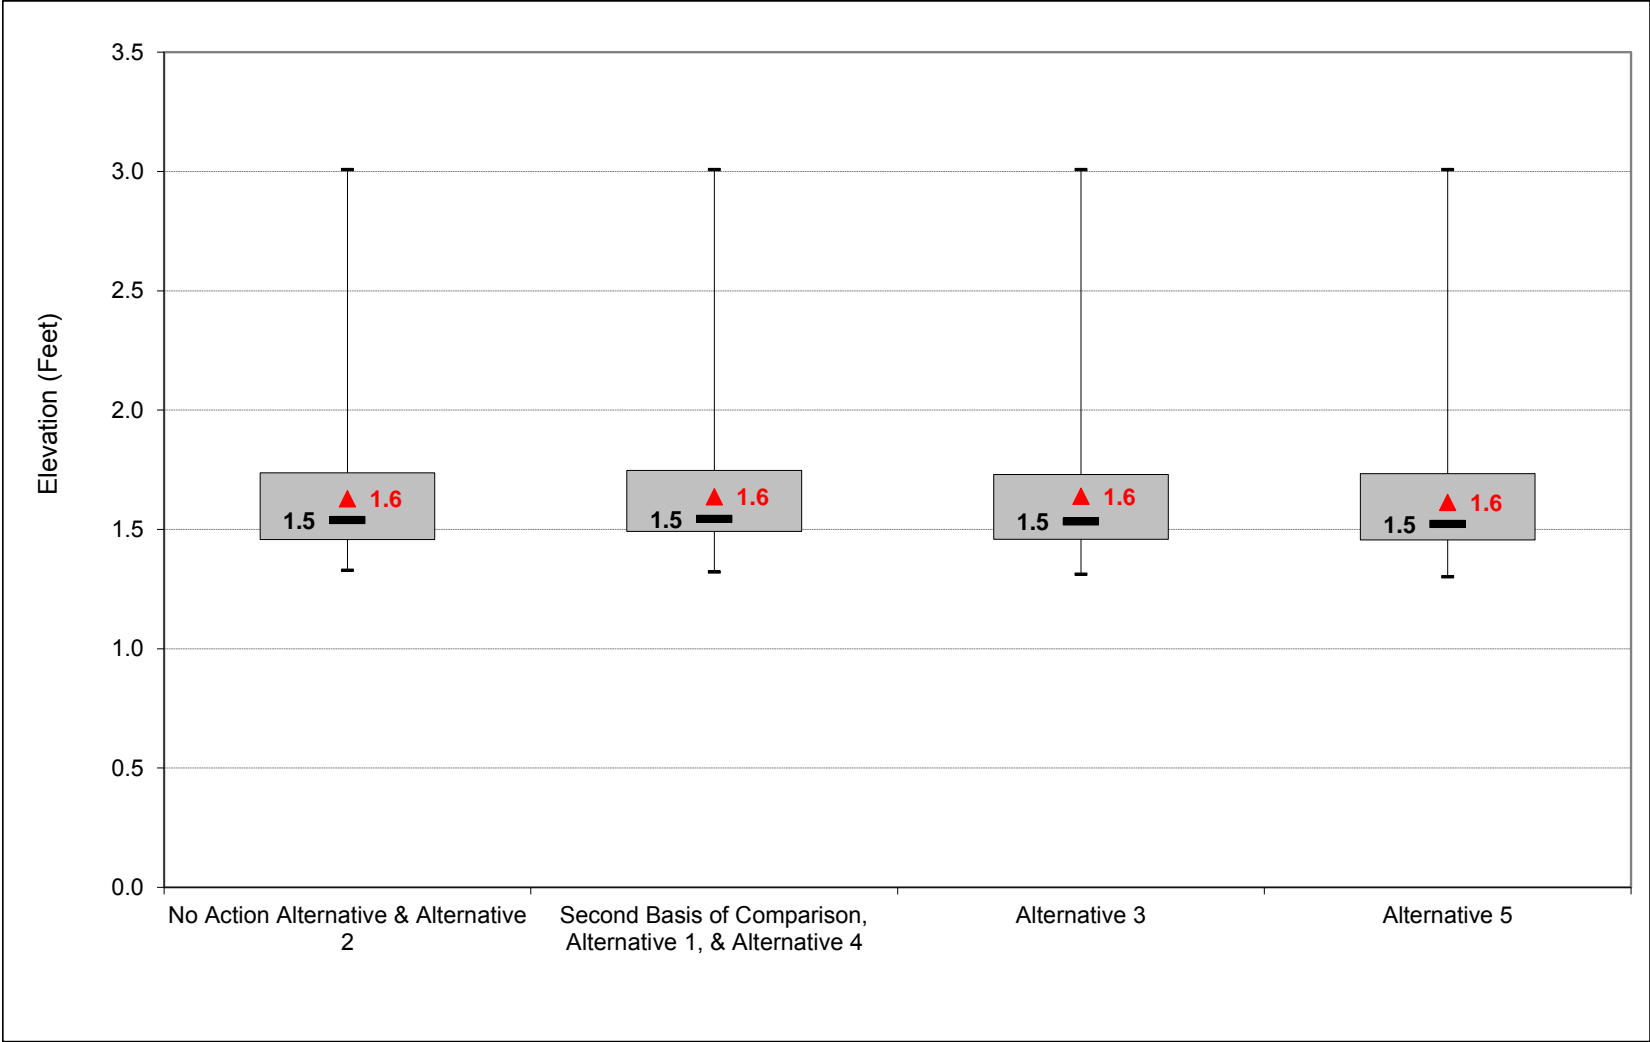

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-41-2-1. Old River at Tracy Blvd, Monthly Averaged Daily Minimum Elevation

No Action Alternative

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1.8	1.7	0.6	1.1	1.8	1.9	1.8	1.6	2.8	2.3	1.9	1.8
20%	1.7	1.6	0.1	0.7	1.2	1.0	1.2	1.0	2.0	1.7	1.8	1.8
30%	1.7	1.6	0.0	0.3	0.8	0.6	0.8	0.7	1.9	1.6	1.7	1.7
40%	1.7	1.5	-0.1	0.1	0.6	0.3	0.5	0.5	1.7	1.5	1.6	1.7
50%	1.6	1.5	-0.2	0.0	0.3	0.2	0.4	0.3	1.6	1.4	1.5	1.6
60%	1.6	1.5	-0.2	-0.1	0.1	0.1	0.2	0.3	1.5	1.4	1.5	1.6
70%	1.5	1.5	-0.3	-0.1	0.1	-0.1	0.0	0.2	1.5	1.3	1.5	1.6
80%	1.5	1.4	-0.4	-0.2	0.0	-0.1	-0.1	0.1	1.4	1.3	1.5	1.5
90%	1.5	1.4	-0.5	-0.2	-0.2	-0.2	-0.2	0.0	1.3	1.2	1.4	1.5
Long Term												
Full Simulation Period ^b	1.6	1.6	0.0	0.5	0.8	0.6	0.6	0.7	1.8	1.6	1.6	1.7
Water Year Types^c												
Wet (32%)	1.7	1.7	0.5	1.4	1.8	1.7	1.6	1.4	2.3	2.0	1.8	1.8
Above Normal (16%)	1.6	1.5	0.0	0.4	0.9	0.5	0.7	0.6	1.9	1.5	1.5	1.6
Below Normal (13%)	1.7	1.6	-0.2	0.0	0.3	0.0	0.3	0.3	1.6	1.4	1.5	1.6
Dry (24%)	1.6	1.5	-0.3	-0.1	0.1	0.1	0.3	0.3	1.5	1.3	1.6	1.6
Critical (15%)	1.6	1.5	-0.2	-0.2	0.0	-0.1	-0.1	0.1	1.4	1.3	1.5	1.6

Alternative 1

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1.6	1.6	0.5	1.2	2.0	2.2	1.6	1.4	3.1	2.3	1.9	1.8
20%	1.6	1.6	0.0	0.6	1.3	1.1	0.5	0.5	2.2	1.7	1.8	1.7
30%	1.5	1.5	0.0	0.1	0.7	0.6	0.1	0.2	1.9	1.6	1.7	1.7
40%	1.5	1.5	-0.2	-0.1	0.3	0.3	0.0	0.1	1.8	1.5	1.6	1.6
50%	1.5	1.5	-0.3	-0.2	0.2	0.1	-0.1	0.0	1.6	1.5	1.5	1.6
60%	1.5	1.5	-0.3	-0.2	0.0	0.0	-0.2	-0.1	1.5	1.4	1.5	1.6
70%	1.4	1.4	-0.4	-0.3	-0.1	-0.1	-0.3	-0.1	1.4	1.3	1.5	1.5
80%	1.4	1.4	-0.4	-0.3	-0.2	-0.2	-0.3	-0.1	1.3	1.3	1.5	1.5
90%	1.4	1.4	-0.5	-0.4	-0.3	-0.3	-0.4	-0.2	1.2	1.2	1.4	1.5
Long Term												
Full Simulation Period ^b	1.5	1.6	0.0	0.3	0.7	0.6	0.3	0.4	1.8	1.6	1.6	1.7
Water Year Types^c												
Wet (32%)	1.6	1.7	0.4	1.2	1.7	1.7	1.2	1.1	2.5	2.0	1.8	1.8
Above Normal (16%)	1.5	1.5	-0.1	0.2	0.8	0.5	0.0	0.1	1.9	1.6	1.6	1.6
Below Normal (13%)	1.5	1.5	-0.2	-0.2	0.2	-0.1	-0.2	0.0	1.5	1.4	1.6	1.6
Dry (24%)	1.5	1.5	-0.3	-0.3	-0.1	0.0	-0.2	0.0	1.5	1.4	1.6	1.6
Critical (15%)	1.5	1.5	-0.2	-0.2	-0.1	-0.2	-0.3	0.0	1.4	1.4	1.5	1.6

Alternative 1 minus No Action Alternative

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-0.2	0.0	-0.1	0.1	0.2	0.2	-0.2	-0.2	0.3	0.0	0.0	0.0
20%	-0.2	0.0	-0.1	-0.2	0.0	0.1	-0.7	-0.5	0.1	0.1	0.0	0.0
30%	-0.1	0.0	0.0	-0.2	0.0	0.0	-0.7	-0.5	0.0	0.0	0.0	0.0
40%	-0.1	0.0	-0.1	-0.2	-0.2	0.0	-0.6	-0.4	0.0	0.0	0.0	0.0
50%	-0.2	0.0	-0.1	-0.2	-0.1	-0.1	-0.5	-0.3	-0.1	0.0	0.0	0.0
60%	-0.1	0.0	-0.1	-0.2	-0.2	-0.1	-0.5	-0.3	0.0	0.0	0.0	0.0
70%	-0.1	0.0	0.0	-0.2	-0.2	-0.1	-0.3	-0.3	-0.1	0.0	0.0	0.0
80%	-0.1	0.0	0.0	-0.1	-0.2	-0.1	-0.2	-0.3	-0.1	0.0	0.0	0.0
90%	-0.1	0.0	0.0	-0.1	-0.1	-0.1	-0.2	-0.2	0.0	0.1	0.0	0.0
Long Term												
Full Simulation Period ^b	-0.1	0.0	0.0	-0.2	-0.1	-0.1	-0.4	-0.3	0.0	0.0	0.0	0.0
Water Year Types^c												
Wet (32%)	-0.2	-0.1	-0.1	-0.1	-0.1	0.0	-0.4	-0.4	0.2	0.0	0.0	0.0
Above Normal (16%)	-0.1	0.0	0.0	-0.2	-0.1	-0.1	-0.6	-0.5	0.0	0.0	0.0	0.0
Below Normal (13%)	-0.2	-0.1	0.0	-0.2	-0.1	-0.1	-0.5	-0.3	-0.1	0.0	0.0	0.0
Dry (24%)	-0.1	0.0	0.0	-0.1	-0.2	-0.1	-0.3	-0.2	0.0	0.1	0.0	0.0
Critical (15%)	-0.1	0.0	0.0	-0.1	-0.1	-0.1	-0.2	-0.1	0.0	0.0	0.0	0.0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-41-2-2. Old River at Tracy Blvd, Monthly Averaged Daily Minimum Elevation

No Action Alternative

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1.8	1.7	0.6	1.1	1.8	1.9	1.8	1.6	2.8	2.3	1.9	1.8
20%	1.7	1.6	0.1	0.7	1.2	1.0	1.2	1.0	2.0	1.7	1.8	1.8
30%	1.7	1.6	0.0	0.3	0.8	0.6	0.8	0.7	1.9	1.6	1.7	1.7
40%	1.7	1.5	-0.1	0.1	0.6	0.3	0.5	0.5	1.7	1.5	1.6	1.7
50%	1.6	1.5	-0.2	0.0	0.3	0.2	0.4	0.3	1.6	1.4	1.5	1.6
60%	1.6	1.5	-0.2	-0.1	0.1	0.1	0.2	0.3	1.5	1.4	1.5	1.6
70%	1.5	1.5	-0.3	-0.1	0.1	-0.1	0.0	0.2	1.5	1.3	1.5	1.6
80%	1.5	1.4	-0.4	-0.2	0.0	-0.1	-0.1	0.1	1.4	1.3	1.5	1.5
90%	1.5	1.4	-0.5	-0.2	-0.2	-0.2	-0.2	0.0	1.3	1.2	1.4	1.5
Long Term												
Full Simulation Period ^b	1.6	1.6	0.0	0.5	0.8	0.6	0.6	0.7	1.8	1.6	1.6	1.7
Water Year Types^c												
Wet (32%)	1.7	1.7	0.5	1.4	1.8	1.7	1.6	1.4	2.3	2.0	1.8	1.8
Above Normal (16%)	1.6	1.5	0.0	0.4	0.9	0.5	0.7	0.6	1.9	1.5	1.5	1.6
Below Normal (13%)	1.7	1.6	-0.2	0.0	0.3	0.0	0.3	0.3	1.6	1.4	1.5	1.6
Dry (24%)	1.6	1.5	-0.3	-0.1	0.1	0.1	0.1	0.3	1.5	1.3	1.6	1.6
Critical (15%)	1.6	1.5	-0.2	-0.2	0.0	-0.1	-0.1	0.1	1.4	1.3	1.5	1.6

Alternative 3

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1.6	1.6	0.6	1.4	2.5	2.2	1.7	1.4	2.8	2.3	2.0	1.9
20%	1.6	1.6	0.1	0.7	1.3	1.0	0.9	0.7	1.9	1.7	1.8	1.8
30%	1.6	1.5	0.0	0.3	0.8	0.5	0.4	0.4	1.7	1.5	1.7	1.7
40%	1.5	1.5	-0.1	0.1	0.6	0.3	0.3	0.2	1.6	1.5	1.6	1.6
50%	1.5	1.5	-0.2	0.0	0.2	0.2	0.1	0.2	1.5	1.4	1.5	1.6
60%	1.5	1.5	-0.3	-0.1	0.1	0.0	0.0	0.1	1.4	1.4	1.5	1.6
70%	1.4	1.4	-0.3	-0.1	0.0	-0.1	-0.1	0.1	1.4	1.3	1.5	1.6
80%	1.4	1.4	-0.4	-0.2	-0.1	-0.2	-0.2	0.0	1.3	1.3	1.5	1.5
90%	1.4	1.4	-0.4	-0.2	-0.2	-0.2	-0.3	0.0	1.2	1.2	1.4	1.5
Long Term												
Full Simulation Period ^b	1.5	1.6	0.0	0.5	0.8	0.6	0.5	0.5	1.7	1.6	1.6	1.7
Water Year Types^c												
Wet (32%)	1.6	1.7	0.5	1.4	1.8	1.7	1.4	1.2	2.2	2.0	1.9	1.9
Above Normal (16%)	1.5	1.5	0.0	0.4	0.9	0.5	0.4	0.4	1.7	1.5	1.5	1.6
Below Normal (13%)	1.5	1.5	-0.2	0.0	0.4	0.0	0.1	0.2	1.5	1.4	1.5	1.6
Dry (24%)	1.5	1.5	-0.3	-0.1	0.1	0.1	0.0	0.2	1.4	1.3	1.6	1.6
Critical (15%)	1.5	1.5	-0.2	-0.2	0.0	-0.1	-0.2	0.1	1.3	1.4	1.5	1.6

Alternative 3 minus No Action Alternative

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-0.2	0.0	0.0	0.2	0.6	0.3	-0.1	-0.3	0.0	0.0	0.2	0.1
20%	-0.1	0.0	0.0	-0.1	0.0	0.0	-0.3	-0.3	-0.2	0.0	0.0	0.0
30%	-0.1	0.0	0.0	0.0	0.0	-0.1	-0.4	-0.3	-0.2	0.0	0.0	0.0
40%	-0.1	0.0	0.0	0.0	0.0	0.0	-0.3	-0.2	-0.2	0.0	0.0	0.0
50%	-0.1	0.0	0.0	0.0	-0.1	0.0	-0.2	-0.2	-0.2	0.0	0.0	0.0
60%	-0.1	0.0	0.0	0.0	0.0	0.0	-0.2	-0.1	-0.1	0.0	0.0	0.0
70%	-0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	-0.1	0.0	0.0	0.0
80%	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.0	0.0	0.0
90%	-0.1	-0.1	0.0	0.0	0.0	0.0	-0.1	-0.1	-0.1	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	-0.1	0.0	0.0	0.0	0.0	0.0	-0.2	-0.2	-0.1	0.0	0.0	0.0
Water Year Types^c												
Wet (32%)	-0.1	-0.1	0.0	0.0	0.1	0.0	-0.2	-0.3	-0.1	0.0	0.0	0.0
Above Normal (16%)	-0.1	0.0	0.0	0.0	0.0	-0.1	-0.3	-0.3	-0.2	0.0	0.0	0.0
Below Normal (13%)	-0.2	-0.1	0.0	0.0	0.0	0.0	-0.2	-0.2	-0.1	0.0	0.0	0.0
Dry (24%)	-0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	-0.1	0.0	0.0	0.0
Critical (15%)	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-41-2.3. Old River at Tracy Blvd, Monthly Averaged Daily Minimum Elevation

No Action Alternative

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1.8	1.7	0.6	1.1	1.8	1.9	1.8	1.6	2.8	2.3	1.9	1.8
20%	1.7	1.6	0.1	0.7	1.2	1.0	1.2	1.0	2.0	1.7	1.8	1.8
30%	1.7	1.6	0.0	0.3	0.8	0.6	0.8	0.7	1.9	1.6	1.7	1.7
40%	1.7	1.5	-0.1	0.1	0.6	0.3	0.5	0.5	1.7	1.5	1.6	1.7
50%	1.6	1.5	-0.2	0.0	0.3	0.2	0.4	0.3	1.6	1.4	1.5	1.6
60%	1.6	1.5	-0.2	-0.1	0.1	0.1	0.2	0.3	1.5	1.4	1.5	1.6
70%	1.5	1.5	-0.3	-0.1	0.1	-0.1	0.0	0.2	1.5	1.3	1.5	1.6
80%	1.5	1.4	-0.4	-0.2	0.0	-0.1	-0.1	0.1	1.4	1.3	1.5	1.5
90%	1.5	1.4	-0.5	-0.2	-0.2	-0.2	-0.2	0.0	1.3	1.2	1.4	1.5
Long Term												
Full Simulation Period ^b	1.6	1.6	0.0	0.5	0.8	0.6	0.6	0.7	1.8	1.6	1.6	1.7
Water Year Types^c												
Wet (32%)	1.7	1.7	0.5	1.4	1.8	1.7	1.6	1.4	2.3	2.0	1.8	1.8
Above Normal (16%)	1.6	1.5	0.0	0.4	0.9	0.5	0.7	0.6	1.9	1.5	1.5	1.6
Below Normal (13%)	1.7	1.6	-0.2	0.0	0.3	0.0	0.3	0.3	1.6	1.4	1.5	1.6
Dry (24%)	1.6	1.5	-0.3	-0.1	0.1	0.1	0.1	0.3	1.5	1.3	1.6	1.6
Critical (15%)	1.6	1.5	-0.2	-0.2	0.0	-0.1	-0.1	0.1	1.4	1.3	1.5	1.6

Alternative 5

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1.8	1.7	0.6	1.1	1.8	1.9	1.8	1.6	2.8	2.3	1.8	1.8
20%	1.7	1.6	0.1	0.7	1.3	1.0	1.2	1.0	2.0	1.7	1.8	1.8
30%	1.7	1.6	0.0	0.3	0.8	0.6	0.7	0.7	1.9	1.6	1.7	1.7
40%	1.7	1.5	-0.1	0.1	0.6	0.3	0.5	0.5	1.7	1.5	1.6	1.7
50%	1.6	1.5	-0.2	0.0	0.3	0.2	0.4	0.4	1.7	1.4	1.5	1.6
60%	1.6	1.5	-0.2	-0.1	0.1	0.1	0.3	0.4	1.5	1.4	1.5	1.6
70%	1.6	1.5	-0.3	-0.1	0.1	-0.1	0.1	0.3	1.5	1.3	1.5	1.6
80%	1.5	1.4	-0.4	-0.2	0.0	-0.1	0.0	0.2	1.4	1.3	1.4	1.5
90%	1.5	1.4	-0.5	-0.2	-0.2	-0.2	-0.1	0.1	1.3	1.1	1.4	1.5
Long Term												
Full Simulation Period ^b	1.6	1.6	0.0	0.5	0.8	0.6	0.7	0.7	1.8	1.6	1.6	1.7
Water Year Types^c												
Wet (32%)	1.7	1.7	0.5	1.4	1.8	1.7	1.6	1.5	2.3	2.0	1.8	1.8
Above Normal (16%)	1.6	1.5	0.0	0.4	0.9	0.5	0.7	0.7	1.9	1.5	1.5	1.6
Below Normal (13%)	1.7	1.6	-0.2	0.0	0.3	0.0	0.3	0.4	1.6	1.4	1.5	1.6
Dry (24%)	1.6	1.5	-0.3	-0.1	0.1	0.1	0.2	0.4	1.5	1.3	1.5	1.6
Critical (15%)	1.6	1.5	-0.2	-0.2	0.0	-0.1	0.0	0.2	1.4	1.3	1.5	1.6

Alternative 5 minus No Action Alternative

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
30%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0
Water Year Types^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-41-2-4. Old River at Tracy Blvd, Monthly Averaged Daily Minimum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1.6	1.6	0.5	1.2	2.0	2.2	1.6	1.4	3.1	2.3	1.9	1.8
20%	1.6	1.6	0.0	0.6	1.3	1.1	0.5	0.5	2.2	1.7	1.8	1.7
30%	1.5	1.5	0.0	0.1	0.7	0.6	0.1	0.2	1.9	1.6	1.7	1.7
40%	1.5	1.5	-0.2	-0.1	0.3	0.3	0.0	0.1	1.8	1.5	1.6	1.6
50%	1.5	1.5	-0.3	-0.2	0.2	0.1	-0.1	0.0	1.6	1.5	1.5	1.6
60%	1.5	1.5	-0.3	-0.2	0.0	0.0	-0.2	-0.1	1.5	1.4	1.5	1.6
70%	1.4	1.4	-0.4	-0.3	-0.1	-0.1	-0.3	-0.1	1.4	1.3	1.5	1.5
80%	1.4	1.4	-0.4	-0.3	-0.2	-0.2	-0.3	-0.1	1.3	1.3	1.5	1.5
90%	1.4	1.4	-0.5	-0.4	-0.3	-0.3	-0.4	-0.2	1.2	1.2	1.4	1.5
Long Term												
Full Simulation Period ^b	1.5	1.6	0.0	0.3	0.7	0.6	0.3	0.4	1.8	1.6	1.6	1.7
Water Year Types ^c												
Wet (32%)	1.6	1.7	0.4	1.2	1.7	1.7	1.2	1.1	2.5	2.0	1.8	1.8
Above Normal (16%)	1.5	1.5	-0.1	0.2	0.8	0.5	0.0	0.1	1.9	1.6	1.6	1.6
Below Normal (13%)	1.5	1.5	-0.2	-0.2	0.2	-0.1	-0.2	0.0	1.5	1.4	1.6	1.6
Dry (24%)	1.5	1.5	-0.3	-0.3	-0.1	0.0	-0.2	0.0	1.5	1.4	1.6	1.6
Critical (15%)	1.5	1.5	-0.2	-0.2	-0.1	-0.2	-0.3	0.0	1.4	1.4	1.5	1.6

No Action Alternative

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1.8	1.7	0.6	1.1	1.8	1.9	1.8	1.6	2.8	2.3	1.9	1.8
20%	1.7	1.6	0.1	0.7	1.2	1.0	1.2	1.0	2.0	1.7	1.8	1.8
30%	1.7	1.6	0.0	0.3	0.8	0.6	0.8	0.7	1.9	1.6	1.7	1.7
40%	1.7	1.5	-0.1	0.1	0.6	0.3	0.5	0.5	1.7	1.5	1.6	1.7
50%	1.6	1.5	-0.2	0.0	0.3	0.2	0.4	0.3	1.6	1.4	1.5	1.6
60%	1.6	1.5	-0.2	-0.1	0.1	0.1	0.2	0.3	1.5	1.4	1.5	1.6
70%	1.5	1.5	-0.3	-0.1	0.1	-0.1	0.0	0.2	1.5	1.3	1.5	1.6
80%	1.5	1.4	-0.4	-0.2	0.0	-0.1	-0.1	0.1	1.4	1.3	1.5	1.5
90%	1.5	1.4	-0.5	-0.2	-0.2	-0.2	-0.2	0.0	1.3	1.2	1.4	1.5
Long Term												
Full Simulation Period ^b	1.6	1.6	0.0	0.5	0.8	0.6	0.6	0.7	1.8	1.6	1.6	1.7
Water Year Types ^c												
Wet (32%)	1.7	1.7	0.5	1.4	1.8	1.7	1.6	1.4	2.3	2.0	1.8	1.8
Above Normal (16%)	1.6	1.5	0.0	0.4	0.9	0.5	0.7	0.6	1.9	1.5	1.5	1.6
Below Normal (13%)	1.7	1.6	-0.2	0.0	0.3	0.0	0.3	0.3	1.6	1.4	1.5	1.6
Dry (24%)	1.6	1.5	-0.3	-0.1	0.1	0.1	0.1	0.3	1.5	1.3	1.6	1.6
Critical (15%)	1.6	1.5	-0.2	-0.2	0.0	-0.1	-0.1	0.1	1.4	1.3	1.5	1.6

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.2	0.0	0.1	-0.1	-0.2	-0.2	0.2	0.2	-0.3	0.0	0.0	0.0
20%	0.2	0.0	0.1	0.2	0.0	-0.1	0.7	0.5	-0.1	-0.1	0.0	0.0
30%	0.1	0.0	0.0	0.2	0.0	0.0	0.7	0.5	0.0	0.0	0.0	0.0
40%	0.1	0.0	0.1	0.2	0.2	0.0	0.6	0.4	0.0	0.0	0.0	0.0
50%	0.2	0.0	0.1	0.2	0.1	0.1	0.5	0.3	0.1	0.0	0.0	0.0
60%	0.1	0.0	0.1	0.2	0.2	0.1	0.5	0.3	0.0	0.0	0.0	0.0
70%	0.1	0.0	0.0	0.2	0.2	0.1	0.3	0.3	0.1	0.0	0.0	0.0
80%	0.1	0.0	0.0	0.1	0.2	0.1	0.2	0.3	0.1	0.0	0.0	0.0
90%	0.1	0.0	0.0	0.1	0.1	0.1	0.2	0.2	0.0	-0.1	0.0	0.0
Long Term												
Full Simulation Period ^b	0.1	0.0	0.0	0.2	0.1	0.1	0.4	0.3	0.0	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.2	0.1	0.1	0.1	0.1	0.0	0.4	0.4	-0.2	0.0	0.0	0.0
Above Normal (16%)	0.1	0.0	0.0	0.2	0.1	0.1	0.6	0.5	0.0	0.0	0.0	0.0
Below Normal (13%)	0.2	0.1	0.0	0.2	0.1	0.1	0.5	0.3	0.1	0.0	0.0	0.0
Dry (24%)	0.1	0.0	0.0	0.1	0.2	0.1	0.3	0.2	0.0	-0.1	0.0	0.0
Critical (15%)	0.1	0.0	0.0	0.1	0.1	0.1	0.2	0.1	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-41-2-5. Old River at Tracy Blvd, Monthly Averaged Daily Minimum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1.6	1.6	0.5	1.2	2.0	2.2	1.6	1.4	3.1	2.3	1.9	1.8
20%	1.6	1.6	0.0	0.6	1.3	1.1	0.5	0.5	2.2	1.7	1.8	1.7
30%	1.5	1.5	0.0	0.1	0.7	0.6	0.1	0.2	1.9	1.6	1.7	1.7
40%	1.5	1.5	-0.2	-0.1	0.3	0.3	0.0	0.1	1.8	1.5	1.6	1.6
50%	1.5	1.5	-0.3	-0.2	0.2	0.1	-0.1	0.0	1.6	1.5	1.5	1.6
60%	1.5	1.5	-0.3	-0.2	0.0	0.0	-0.2	-0.1	1.5	1.4	1.5	1.6
70%	1.4	1.4	-0.4	-0.3	-0.1	-0.1	-0.3	-0.1	1.4	1.3	1.5	1.5
80%	1.4	1.4	-0.4	-0.3	-0.2	-0.2	-0.3	-0.1	1.3	1.3	1.5	1.5
90%	1.4	1.4	-0.5	-0.4	-0.3	-0.3	-0.4	-0.2	1.2	1.2	1.4	1.5
Long Term												
Full Simulation Period ^b	1.5	1.6	0.0	0.3	0.7	0.6	0.3	0.4	1.8	1.6	1.6	1.7
Water Year Types ^c												
Wet (32%)	1.6	1.7	0.4	1.2	1.7	1.7	1.2	1.1	2.5	2.0	1.8	1.8
Above Normal (16%)	1.5	1.5	-0.1	0.2	0.8	0.5	0.0	0.1	1.9	1.6	1.6	1.6
Below Normal (13%)	1.5	1.5	-0.2	-0.2	0.2	-0.1	-0.2	0.0	1.5	1.4	1.6	1.6
Dry (24%)	1.5	1.5	-0.3	-0.3	-0.1	0.0	-0.2	0.0	1.5	1.4	1.6	1.6
Critical (15%)	1.5	1.5	-0.2	-0.2	-0.1	-0.2	-0.3	0.0	1.4	1.4	1.5	1.6

Alternative 3

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1.6	1.6	0.6	1.4	2.5	2.2	1.7	1.4	2.8	2.3	2.0	1.9
20%	1.6	1.6	0.1	0.7	1.3	1.0	0.9	0.7	1.9	1.7	1.8	1.8
30%	1.6	1.5	0.0	0.3	0.8	0.5	0.4	0.4	1.7	1.5	1.7	1.7
40%	1.5	1.5	-0.1	0.1	0.6	0.3	0.3	0.2	1.6	1.5	1.6	1.6
50%	1.5	1.5	-0.2	0.0	0.2	0.2	0.1	0.2	1.5	1.4	1.5	1.6
60%	1.5	1.5	-0.3	-0.1	0.1	0.0	0.0	0.1	1.4	1.4	1.5	1.6
70%	1.4	1.4	-0.3	-0.1	0.0	-0.1	-0.1	0.1	1.4	1.3	1.5	1.6
80%	1.4	1.4	-0.4	-0.2	-0.1	-0.2	-0.2	0.0	1.3	1.3	1.5	1.5
90%	1.4	1.4	-0.4	-0.2	-0.2	-0.2	-0.3	0.0	1.2	1.2	1.4	1.5
Long Term												
Full Simulation Period ^b	1.5	1.6	0.0	0.5	0.8	0.6	0.5	0.5	1.7	1.6	1.6	1.7
Water Year Types ^c												
Wet (32%)	1.6	1.7	0.5	1.4	1.8	1.7	1.4	1.2	2.2	2.0	1.9	1.9
Above Normal (16%)	1.5	1.5	0.0	0.4	0.9	0.5	0.4	0.4	1.7	1.5	1.5	1.6
Below Normal (13%)	1.5	1.5	-0.2	0.0	0.4	0.0	0.1	0.2	1.5	1.4	1.5	1.6
Dry (24%)	1.5	1.5	-0.3	-0.1	0.1	0.1	0.0	0.2	1.4	1.3	1.6	1.6
Critical (15%)	1.5	1.5	-0.2	-0.2	0.0	-0.1	-0.2	0.1	1.3	1.4	1.5	1.6

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.0	0.1	0.1	0.5	0.0	0.1	-0.1	-0.3	0.0	0.1	0.1
20%	0.0	0.0	0.1	0.1	0.0	-0.2	0.4	0.2	-0.3	-0.1	0.0	0.0
30%	0.0	0.0	0.0	0.3	0.0	0.0	0.3	0.2	-0.2	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.2	0.3	0.0	0.3	0.1	-0.2	0.0	0.0	0.0
50%	0.0	0.0	0.1	0.2	0.1	0.1	0.3	0.2	-0.1	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.1	0.2	0.1	0.2	0.2	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.2	0.2	0.0	0.2	0.2	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.2	0.2	0.1	0.2	0.1	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.2	0.1	0.1	0.1	0.1	-0.1	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.1	0.2	0.1	0.0	0.2	0.1	-0.1	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.1	0.1	0.1	0.0	0.2	0.1	-0.3	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.1	0.2	0.1	0.0	0.3	0.2	-0.1	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.2	0.1	0.0	0.3	0.2	0.0	0.0	-0.1	0.0
Dry (24%)	0.0	0.0	0.0	0.1	0.2	0.1	0.2	0.2	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-41-2-6. Old River at Tracy Blvd, Monthly Averaged Daily Minimum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1.6	1.6	0.5	1.2	2.0	2.2	1.6	1.4	3.1	2.3	1.9	1.8
20%	1.6	1.6	0.0	0.6	1.3	1.1	0.5	0.5	2.2	1.7	1.8	1.7
30%	1.5	1.5	0.0	0.1	0.7	0.6	0.1	0.2	1.9	1.6	1.7	1.7
40%	1.5	1.5	-0.2	-0.1	0.3	0.3	0.0	0.1	1.8	1.5	1.6	1.6
50%	1.5	1.5	-0.3	-0.2	0.2	0.1	-0.1	0.0	1.6	1.5	1.5	1.6
60%	1.5	1.5	-0.3	-0.2	0.0	0.0	-0.2	-0.1	1.5	1.4	1.5	1.6
70%	1.4	1.4	-0.4	-0.3	-0.1	-0.1	-0.3	-0.1	1.4	1.3	1.5	1.5
80%	1.4	1.4	-0.4	-0.3	-0.2	-0.2	-0.3	-0.1	1.3	1.3	1.5	1.5
90%	1.4	1.4	-0.5	-0.4	-0.3	-0.3	-0.4	-0.2	1.2	1.2	1.4	1.5
Long Term												
Full Simulation Period ^b	1.5	1.6	0.0	0.3	0.7	0.6	0.3	0.4	1.8	1.6	1.6	1.7
Water Year Types ^c												
Wet (32%)	1.6	1.7	0.4	1.2	1.7	1.7	1.2	1.1	2.5	2.0	1.8	1.8
Above Normal (16%)	1.5	1.5	-0.1	0.2	0.8	0.5	0.0	0.1	1.9	1.6	1.6	1.6
Below Normal (13%)	1.5	1.5	-0.2	-0.2	0.2	-0.1	-0.2	0.0	1.5	1.4	1.6	1.6
Dry (24%)	1.5	1.5	-0.3	-0.3	-0.1	0.0	-0.2	0.0	1.5	1.4	1.6	1.6
Critical (15%)	1.5	1.5	-0.2	-0.2	-0.1	-0.2	-0.3	0.0	1.4	1.4	1.5	1.6

Alternative 5

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1.8	1.7	0.6	1.1	1.8	1.9	1.8	1.6	2.8	2.3	1.8	1.8
20%	1.7	1.6	0.1	0.7	1.3	1.0	1.2	1.0	2.0	1.7	1.8	1.8
30%	1.7	1.6	0.0	0.3	0.8	0.6	0.7	0.7	1.9	1.6	1.7	1.7
40%	1.7	1.5	-0.1	0.1	0.6	0.3	0.5	0.5	1.7	1.5	1.6	1.7
50%	1.6	1.5	-0.2	0.0	0.3	0.2	0.4	0.4	1.7	1.4	1.5	1.6
60%	1.6	1.5	-0.2	-0.1	0.1	0.1	0.3	0.4	1.5	1.4	1.5	1.6
70%	1.6	1.5	-0.3	-0.1	0.1	-0.1	0.1	0.3	1.5	1.3	1.5	1.6
80%	1.5	1.4	-0.4	-0.2	0.0	-0.1	0.0	0.2	1.4	1.3	1.4	1.5
90%	1.5	1.4	-0.5	-0.2	-0.2	-0.2	-0.1	0.1	1.3	1.1	1.4	1.5
Long Term												
Full Simulation Period ^b	1.6	1.6	0.0	0.5	0.8	0.6	0.7	0.7	1.8	1.6	1.6	1.7
Water Year Types ^c												
Wet (32%)	1.7	1.7	0.5	1.4	1.8	1.7	1.6	1.5	2.3	2.0	1.8	1.8
Above Normal (16%)	1.6	1.5	0.0	0.4	0.9	0.5	0.7	0.7	1.9	1.5	1.5	1.6
Below Normal (13%)	1.7	1.6	-0.2	0.0	0.3	0.0	0.3	0.4	1.6	1.4	1.5	1.6
Dry (24%)	1.6	1.5	-0.3	-0.1	0.1	0.1	0.2	0.4	1.5	1.3	1.5	1.6
Critical (15%)	1.6	1.5	-0.2	-0.2	0.0	-0.1	0.0	0.2	1.4	1.3	1.5	1.6

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.2	0.0	0.1	-0.1	-0.2	-0.2	0.2	0.2	-0.3	0.0	-0.1	0.0
20%	0.2	0.1	0.1	0.2	0.0	-0.1	0.7	0.5	-0.1	-0.1	0.0	0.0
30%	0.1	0.0	0.0	0.2	0.0	0.0	0.6	0.5	0.0	0.0	0.0	0.0
40%	0.1	0.0	0.1	0.2	0.2	0.0	0.6	0.4	0.0	0.0	0.0	0.0
50%	0.2	0.0	0.1	0.2	0.1	0.1	0.6	0.4	0.1	0.0	0.0	0.0
60%	0.1	0.0	0.1	0.2	0.2	0.1	0.5	0.4	0.0	0.0	0.0	0.0
70%	0.1	0.0	0.0	0.2	0.2	0.1	0.4	0.4	0.1	0.0	0.0	0.0
80%	0.1	0.0	0.0	0.1	0.2	0.1	0.3	0.4	0.1	-0.1	0.0	0.0
90%	0.1	0.0	0.0	0.1	0.1	0.1	0.3	0.3	0.0	-0.1	0.0	0.0
Long Term												
Full Simulation Period ^b	0.1	0.0	0.0	0.2	0.1	0.1	0.4	0.4	0.0	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.2	0.0	0.1	0.1	0.1	0.0	0.4	0.4	-0.2	0.0	0.0	0.0
Above Normal (16%)	0.1	0.0	0.0	0.2	0.1	0.0	0.6	0.5	0.0	0.0	0.0	0.0
Below Normal (13%)	0.2	0.1	0.0	0.2	0.1	0.1	0.5	0.4	0.1	0.0	0.0	0.0
Dry (24%)	0.1	0.0	0.0	0.1	0.2	0.1	0.4	0.3	0.0	-0.1	0.0	0.0
Critical (15%)	0.1	0.0	0.0	0.1	0.1	0.1	0.3	0.2	0.0	-0.1	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 **C.42. Mokelumne River at Terminous Water Surface Elevation**

Figure C-42-1-1. Mokelumne River at Terminous, Monthly Averaged Daily Maximum Elevation, October

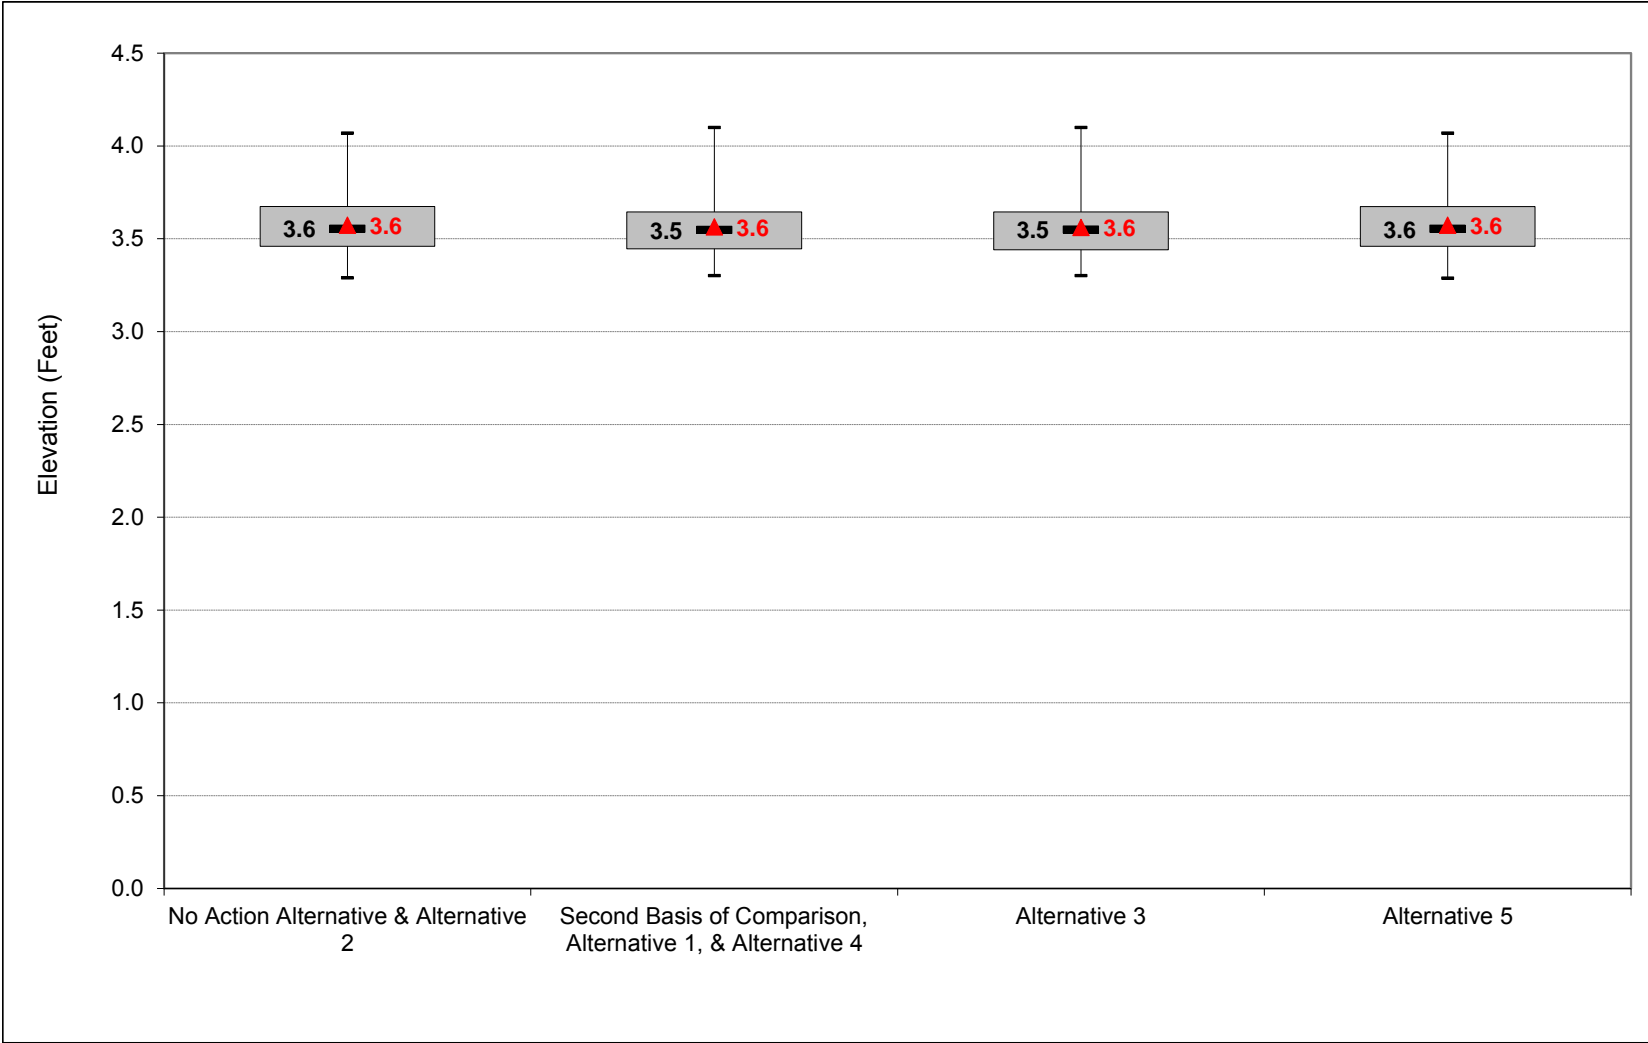


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-42-1-2. Mokelumne River at Terminous, Monthly Averaged Daily Maximum Elevation, November

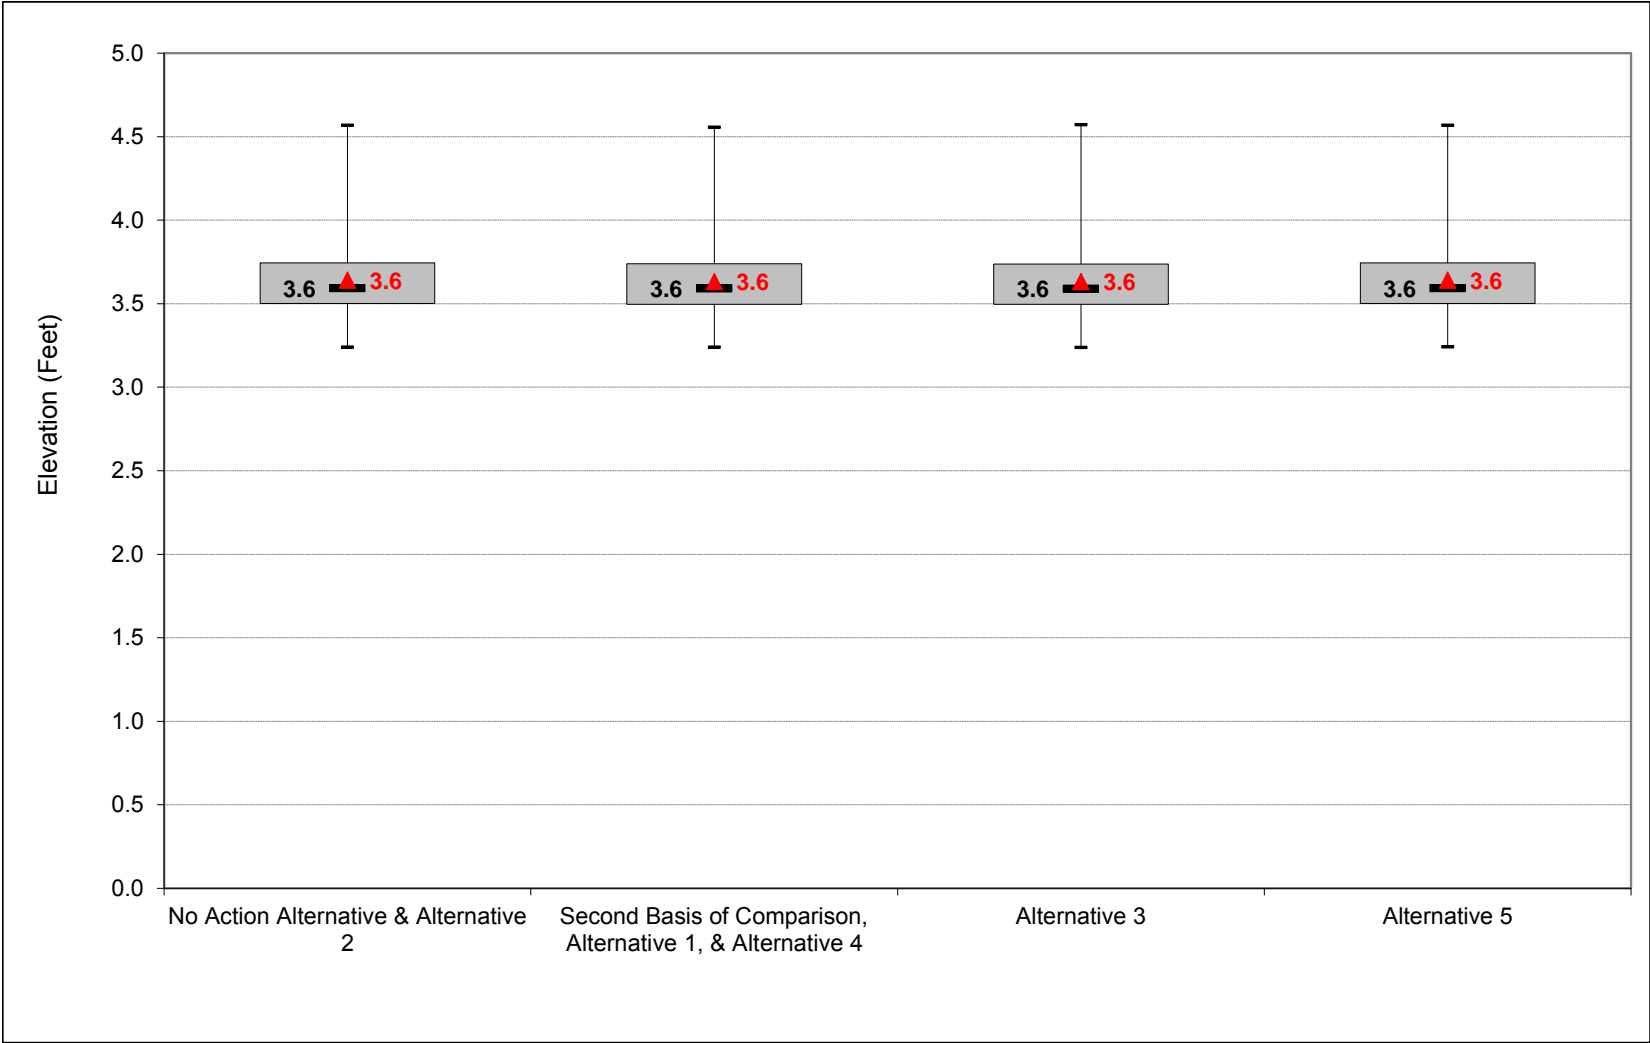


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-42-1-3. Mokelumne River at Terminous, Monthly Averaged Daily Maximum Elevation, December

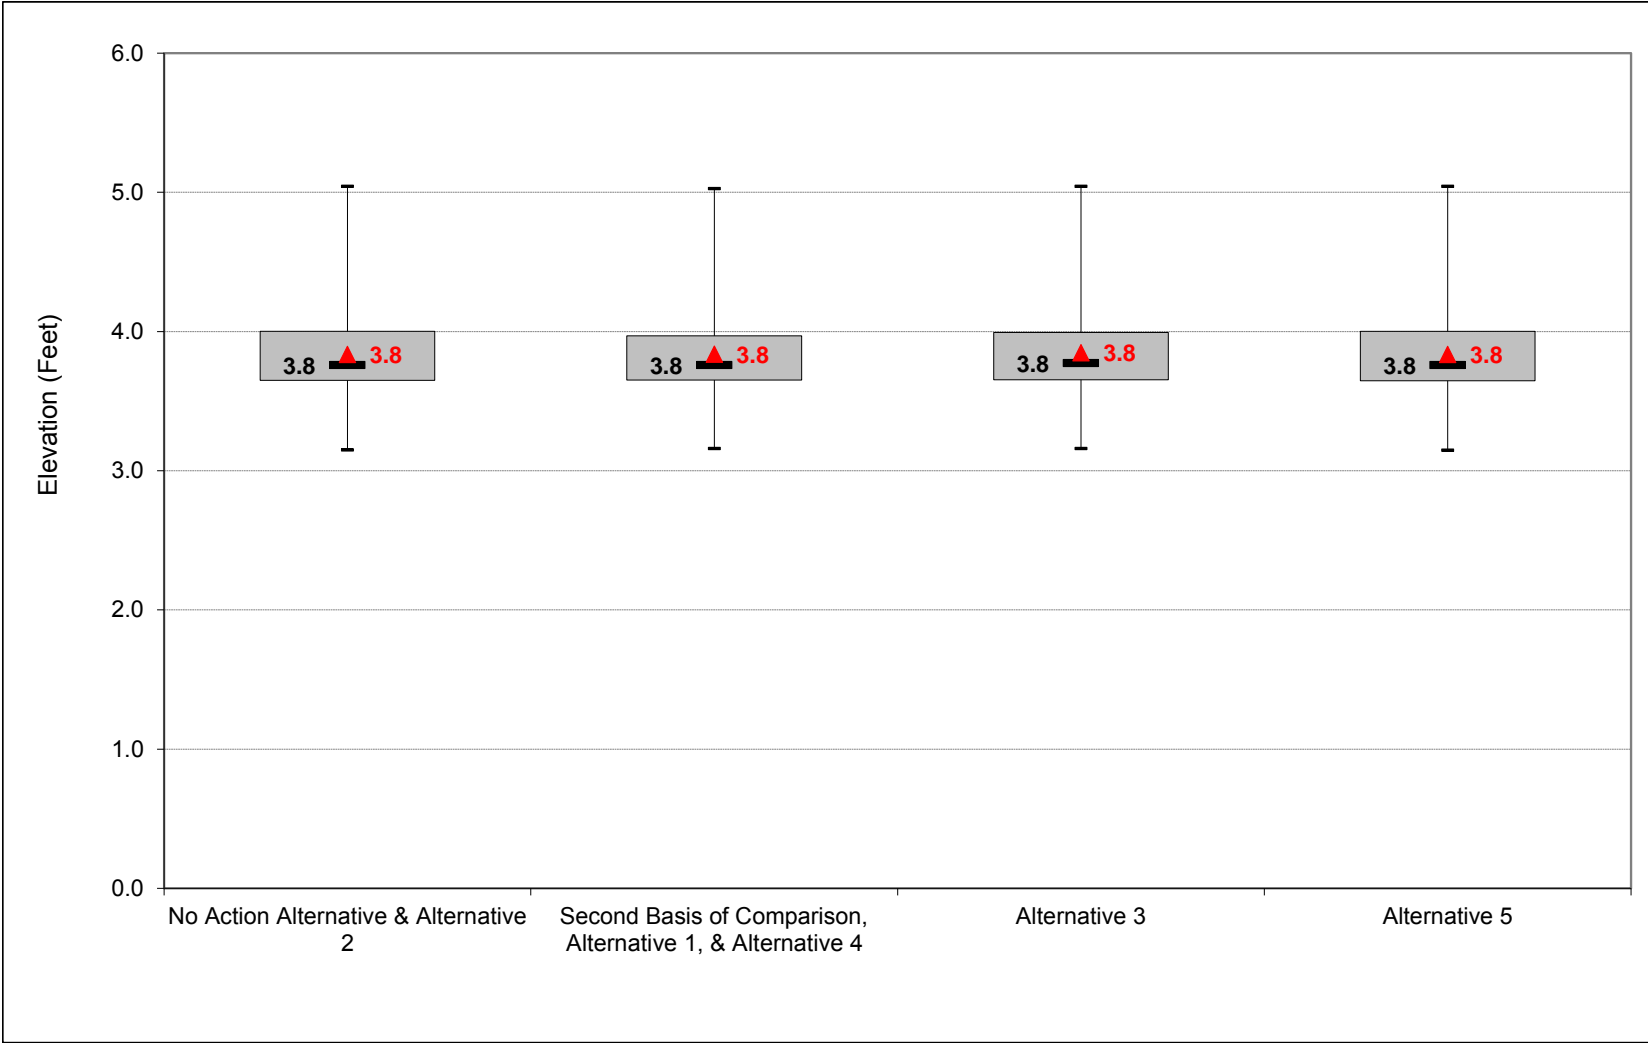


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-42-1-4. Mokelumne River at Terminous, Monthly Averaged Daily Maximum Elevation, January

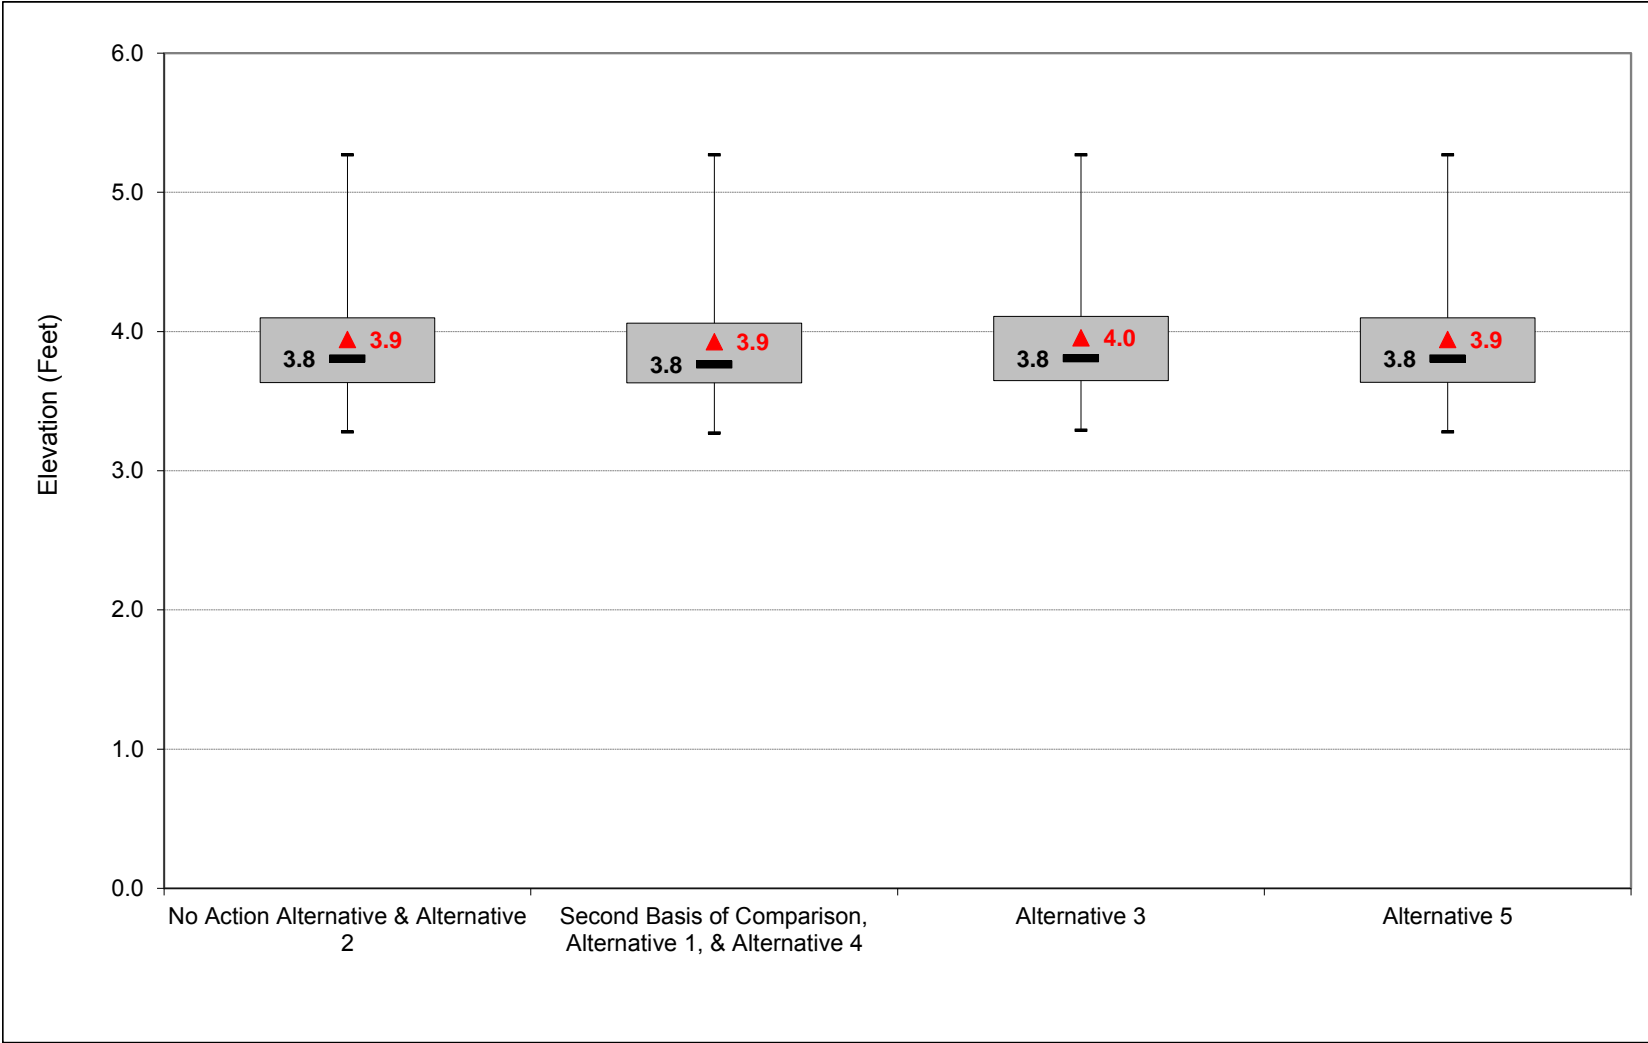


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-42-1-5. Mokelumne River at Terminous, Monthly Averaged Daily Maximum Elevation, February

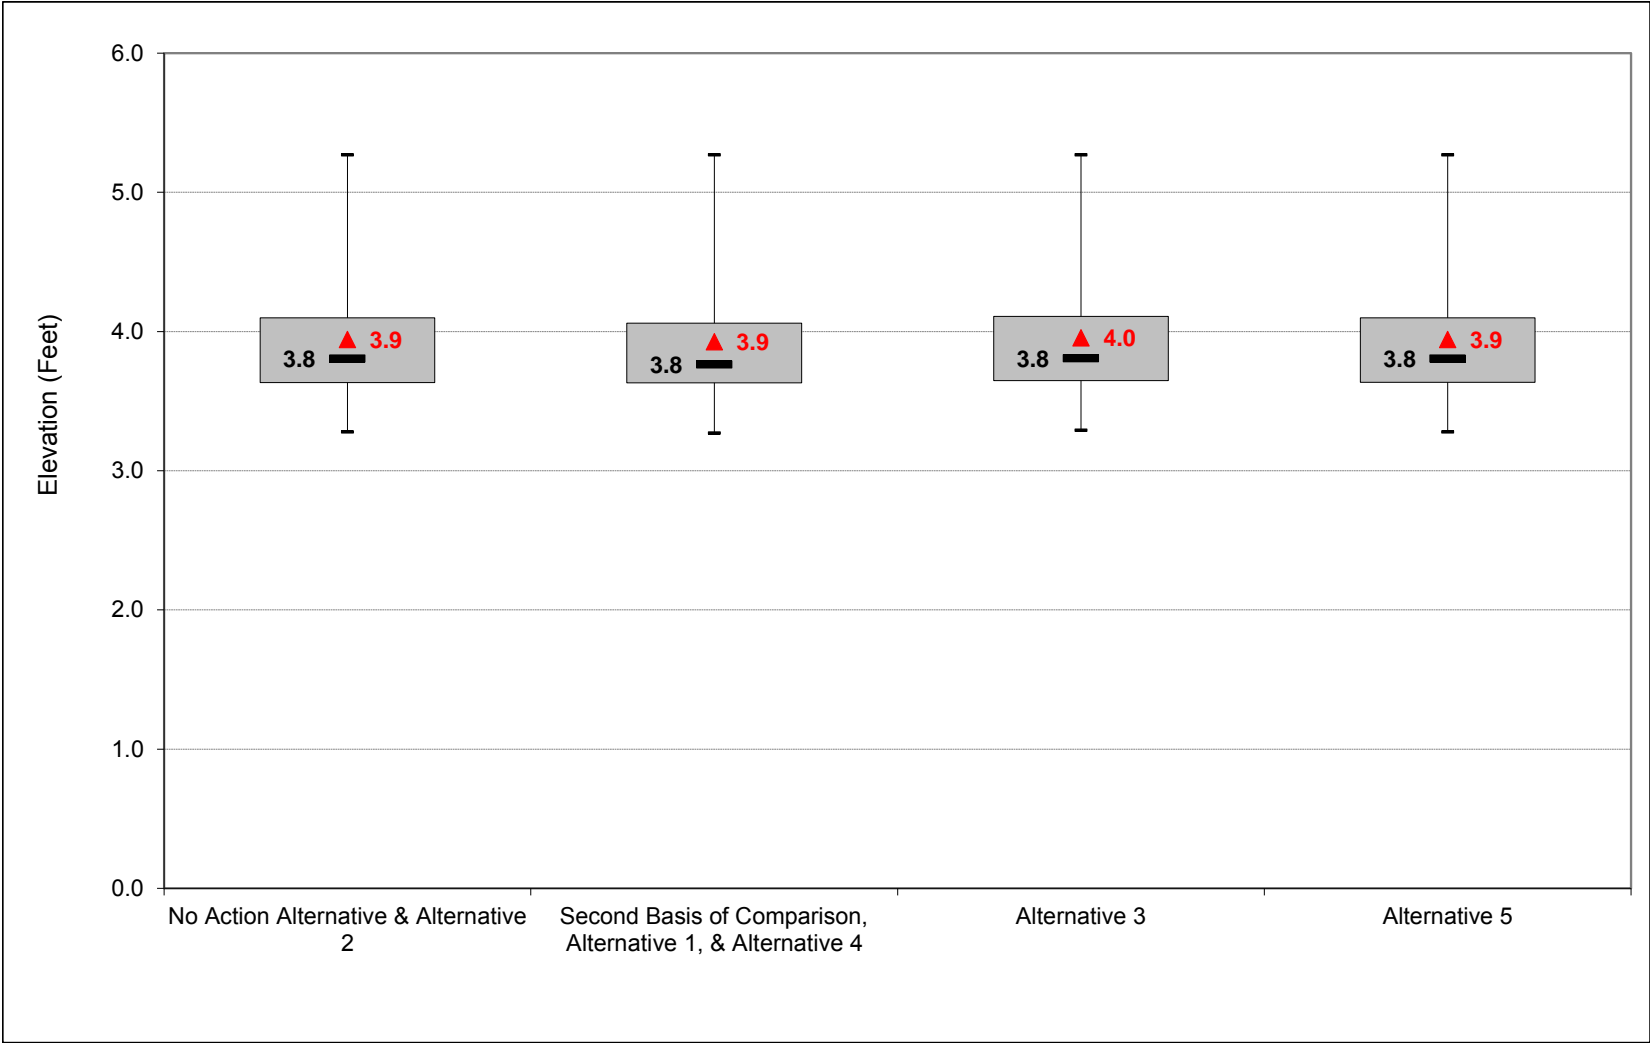


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-42-1-6. Mokelumne River at Terminous, Monthly Averaged Daily Maximum Elevation, March

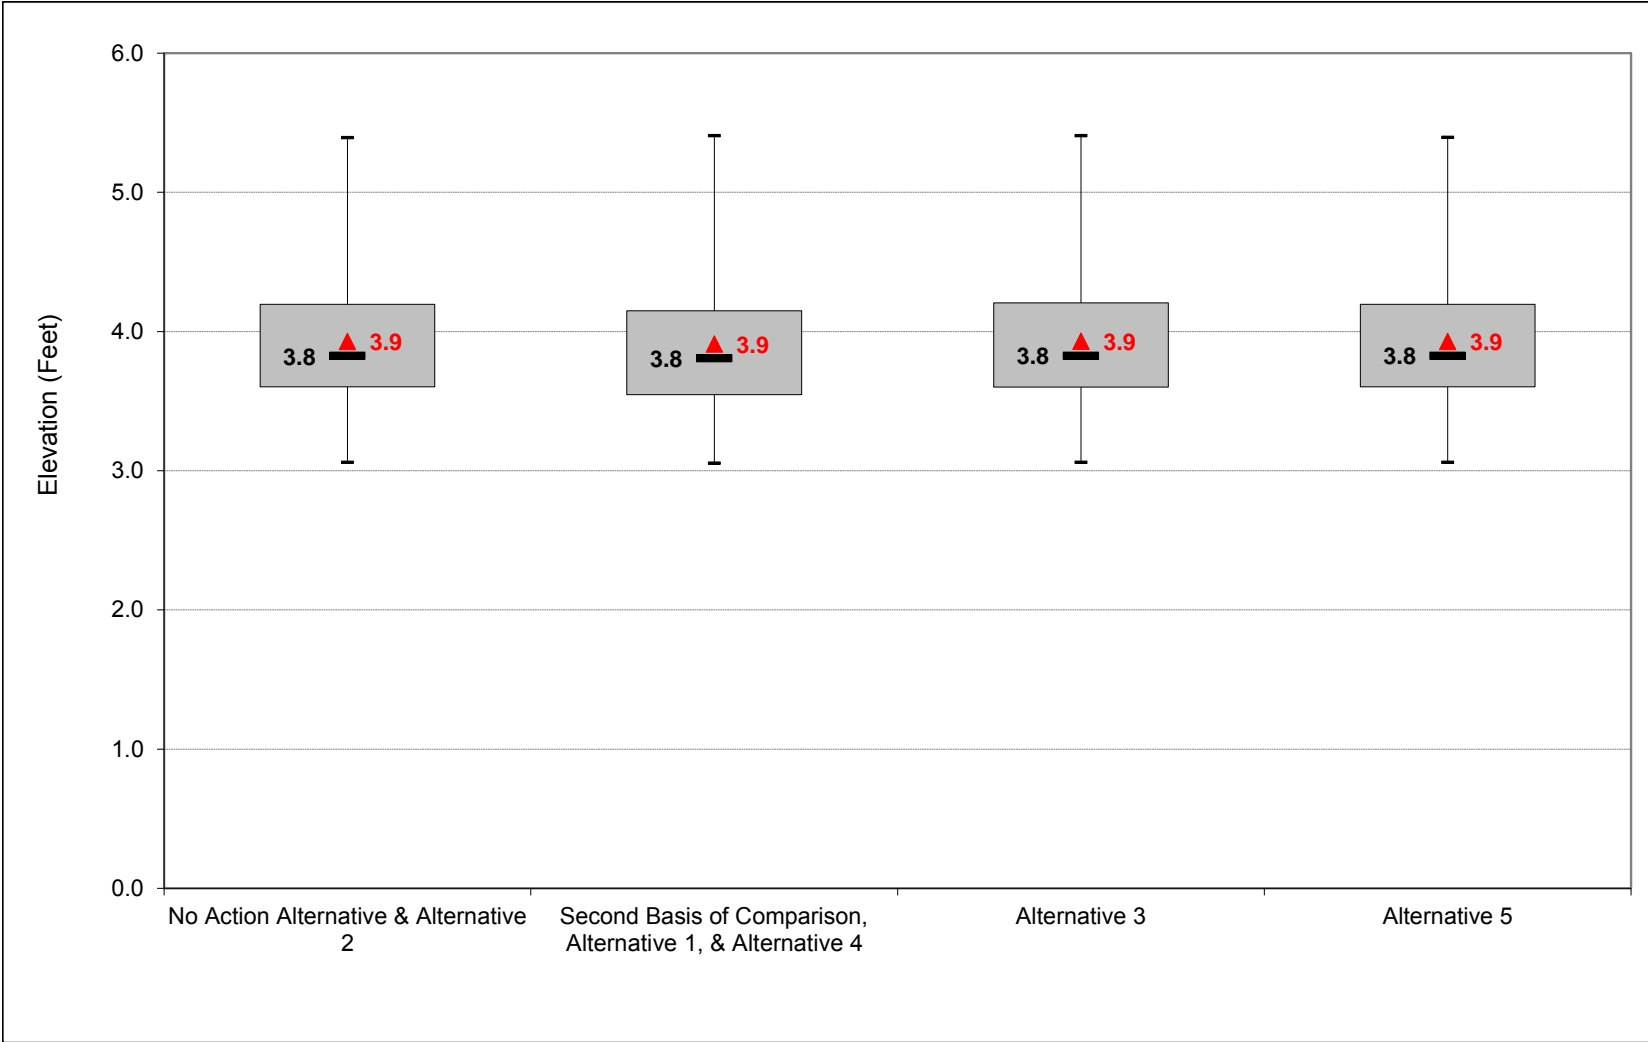


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-42-1-7. Mokelumne River at Terminous, Monthly Averaged Daily Maximum Elevation, April

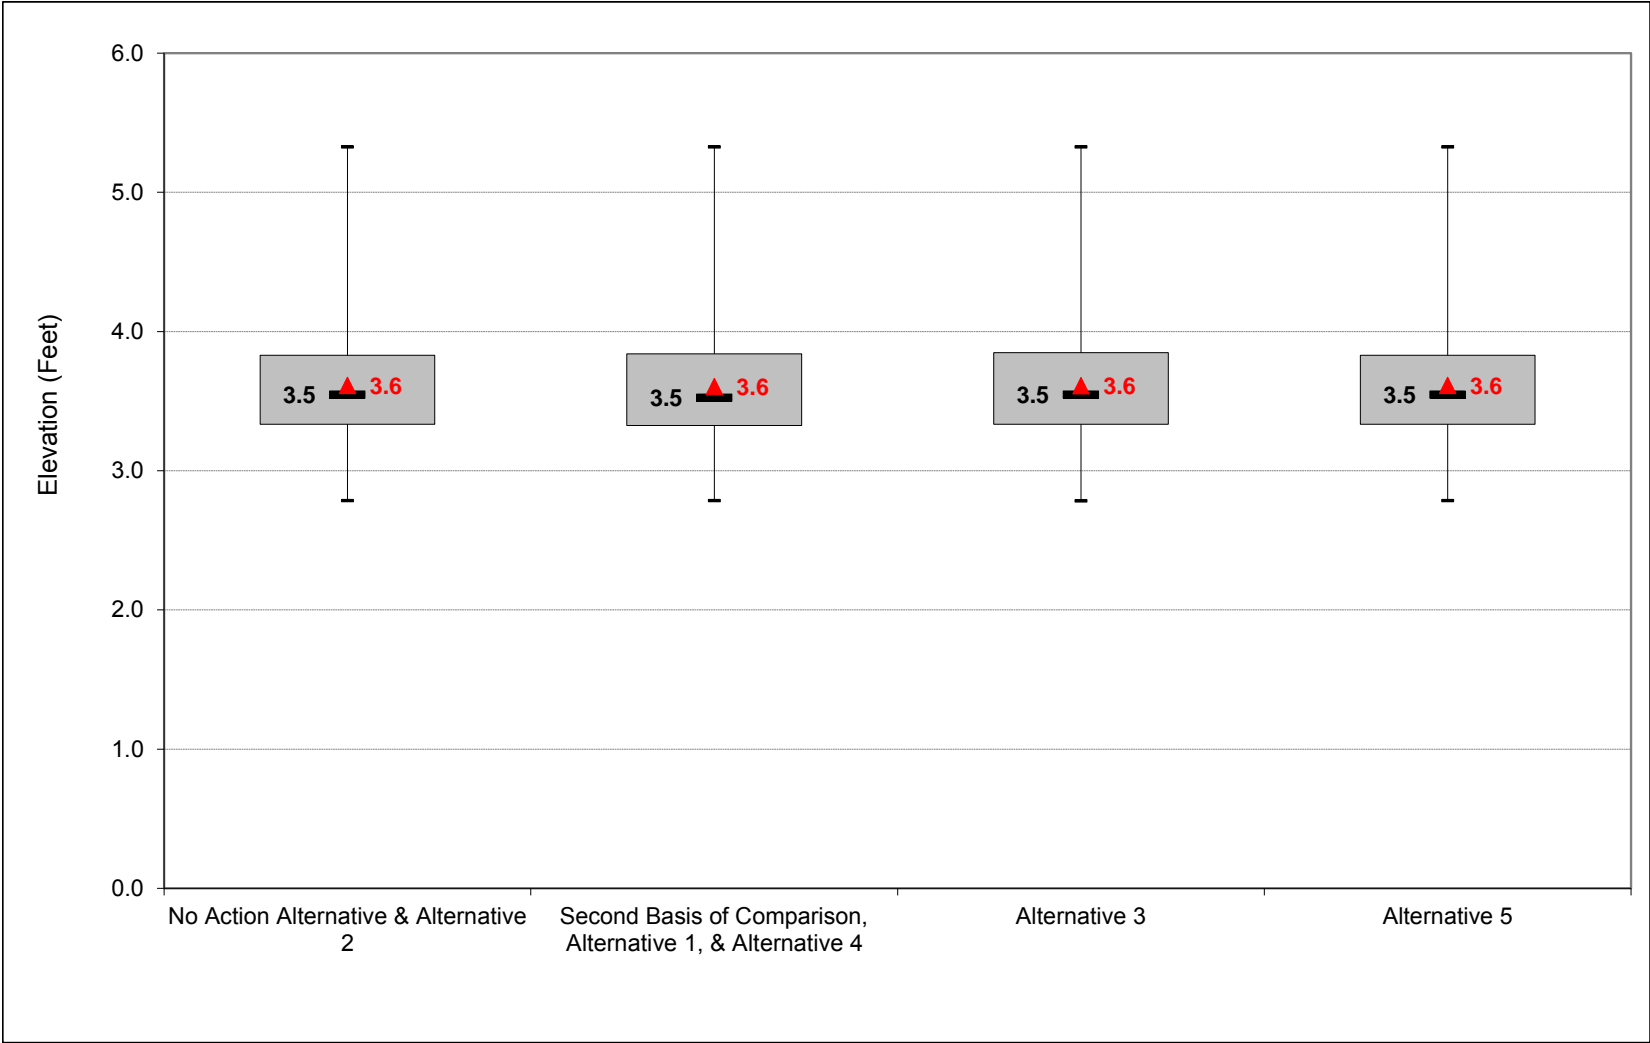


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-42-1-8. Mokelumne River at Terminous, Monthly Averaged Daily Maximum Elevation, May

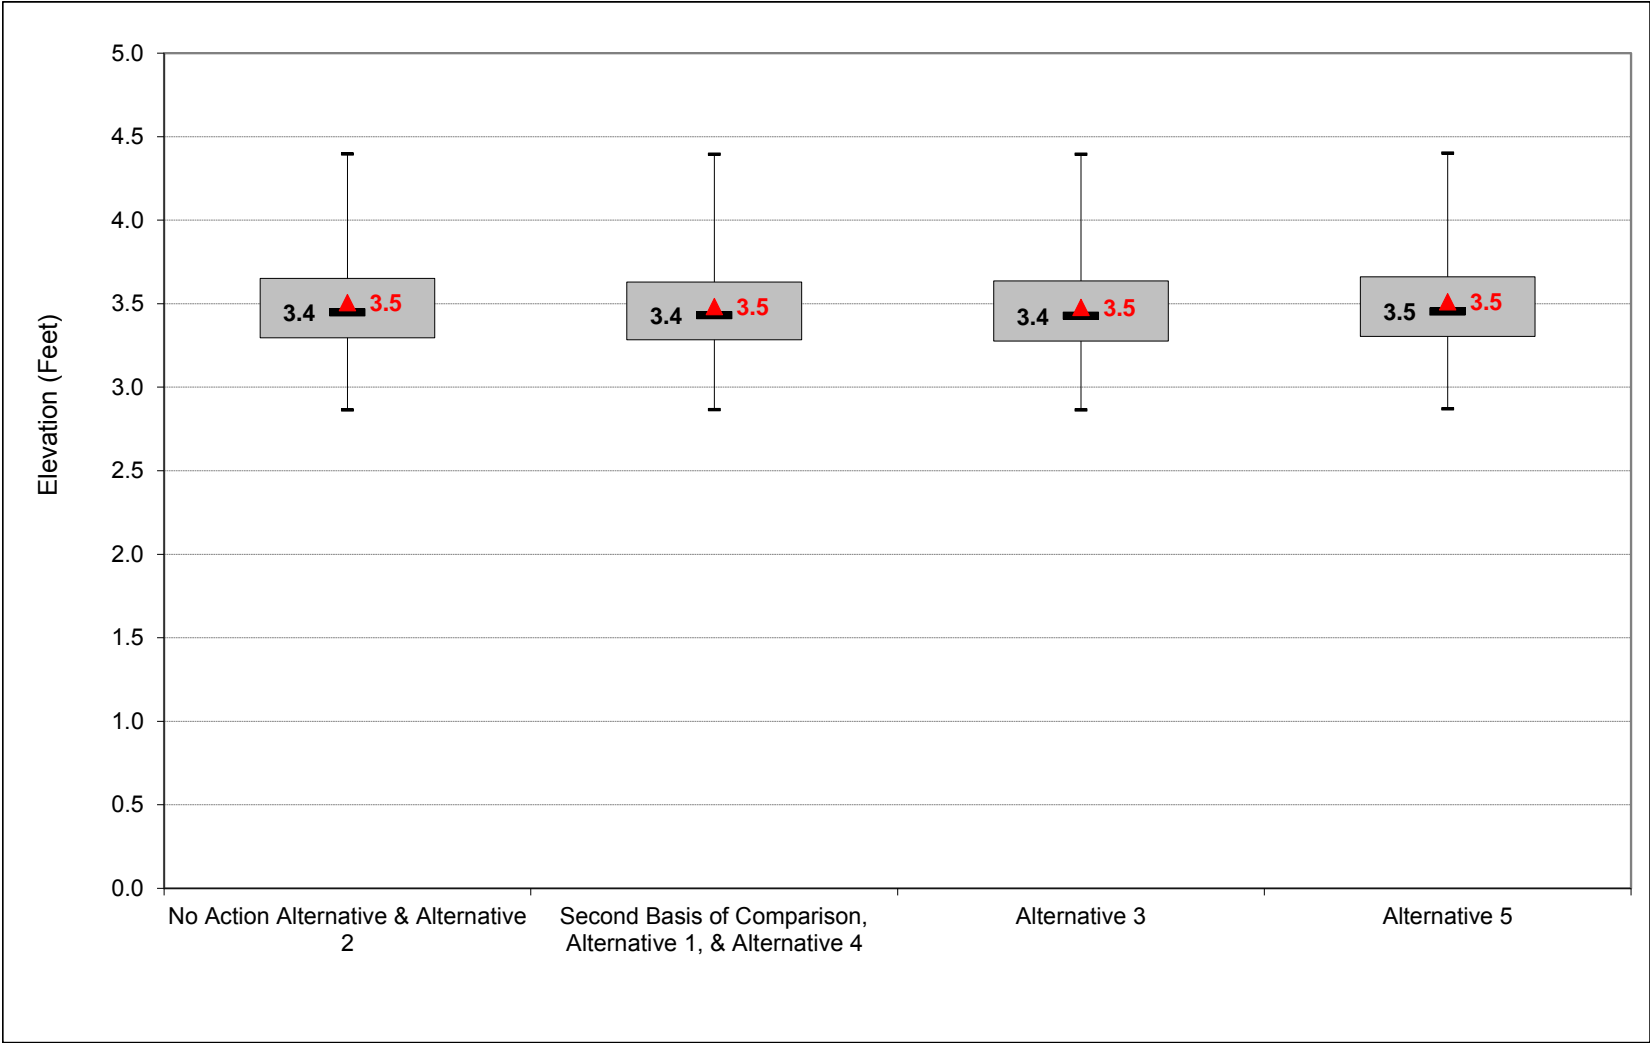


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-42-1-9. Mokelumne River at Terminous, Monthly Averaged Daily Maximum Elevation, June

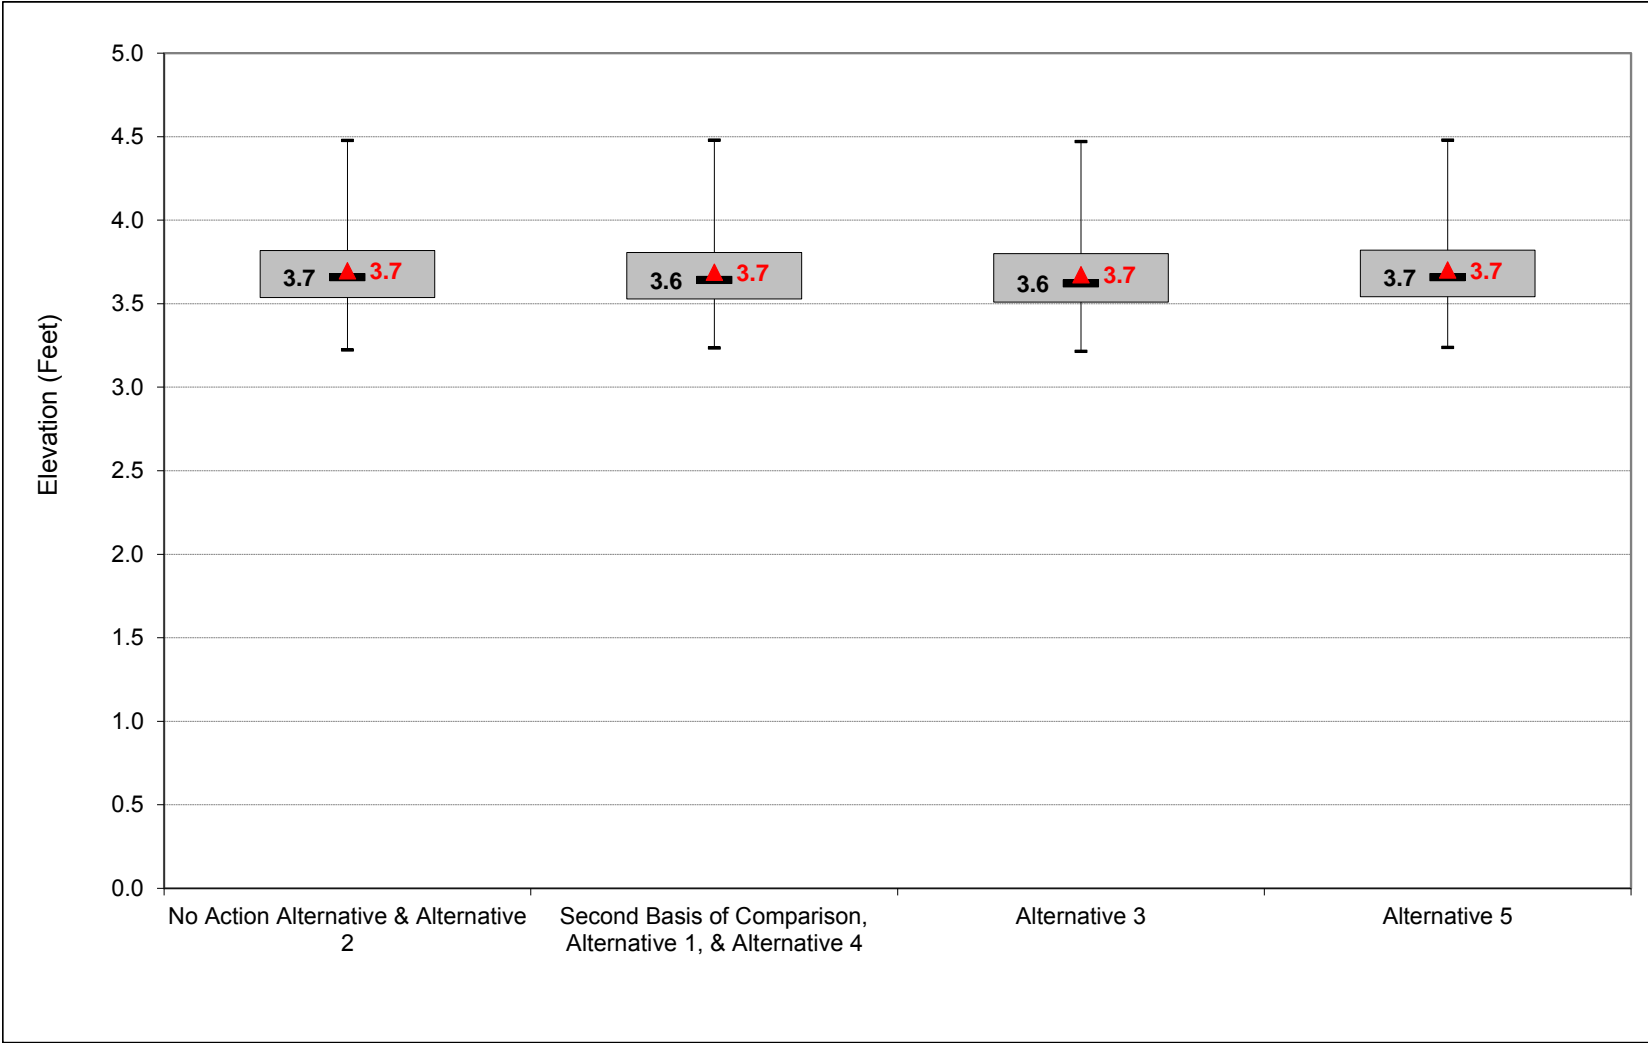


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-42-1-10. Mokelumne River at Terminous, Monthly Averaged Daily Maximum Elevation, July

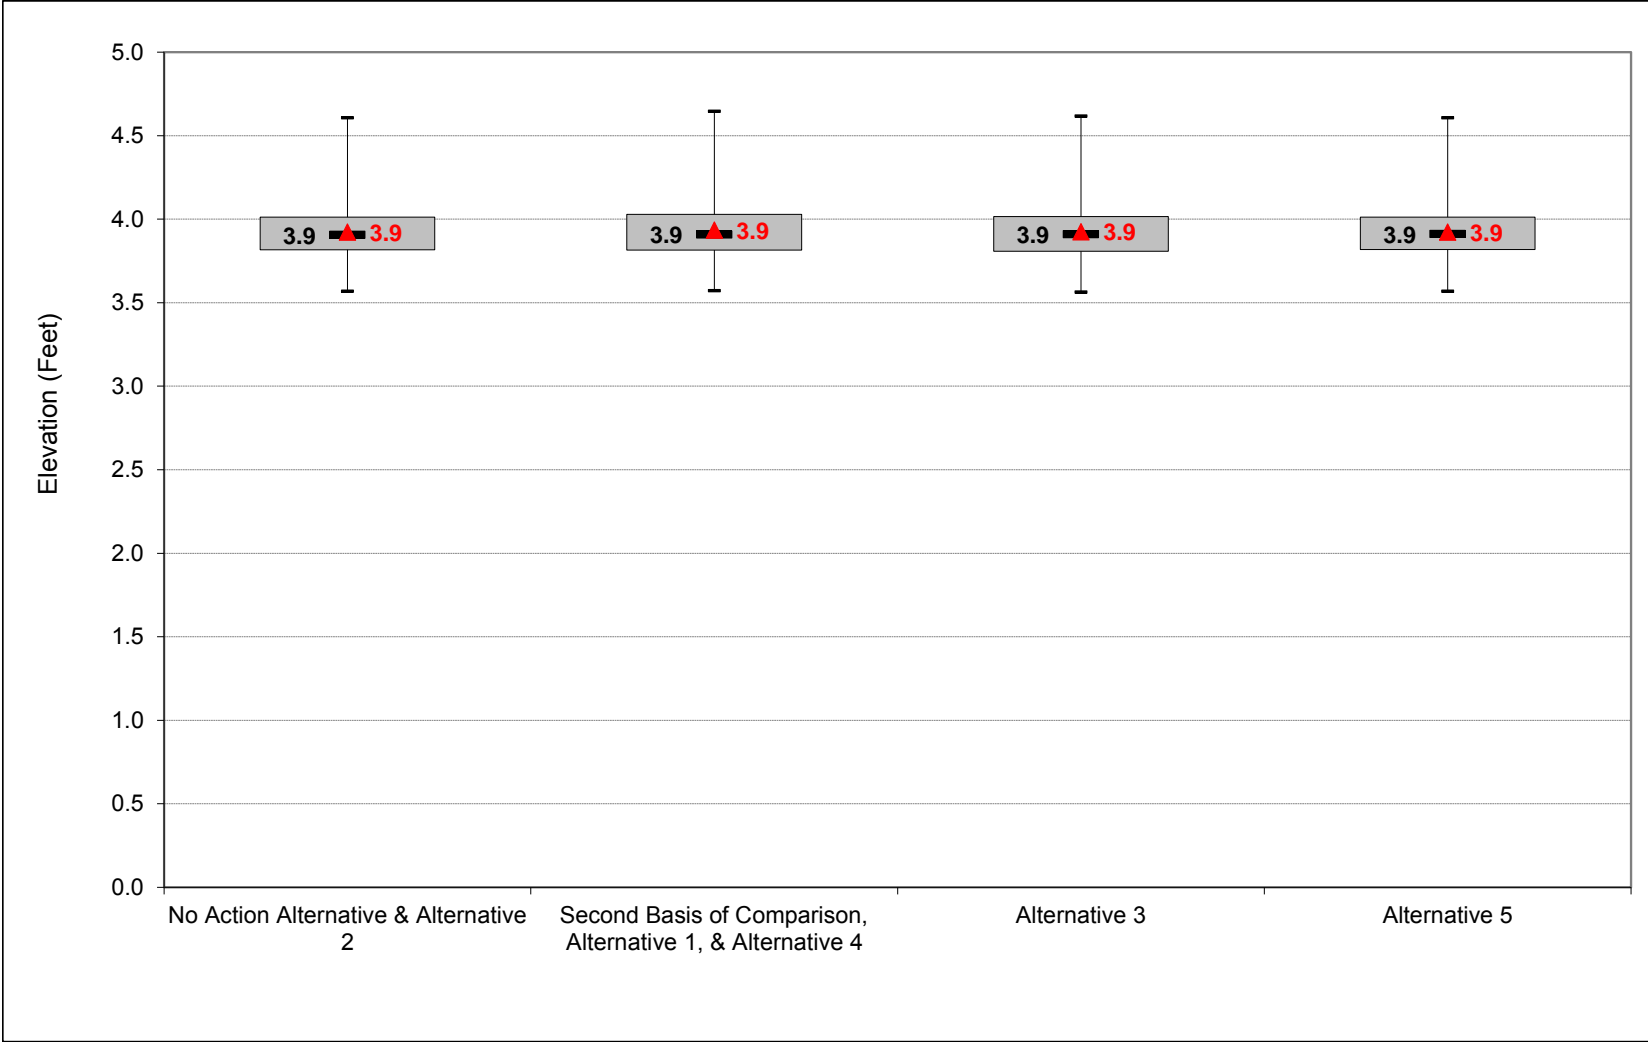


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-42-1-11. Mokelumne River at Terminous, Monthly Averaged Daily Maximum Elevation, August

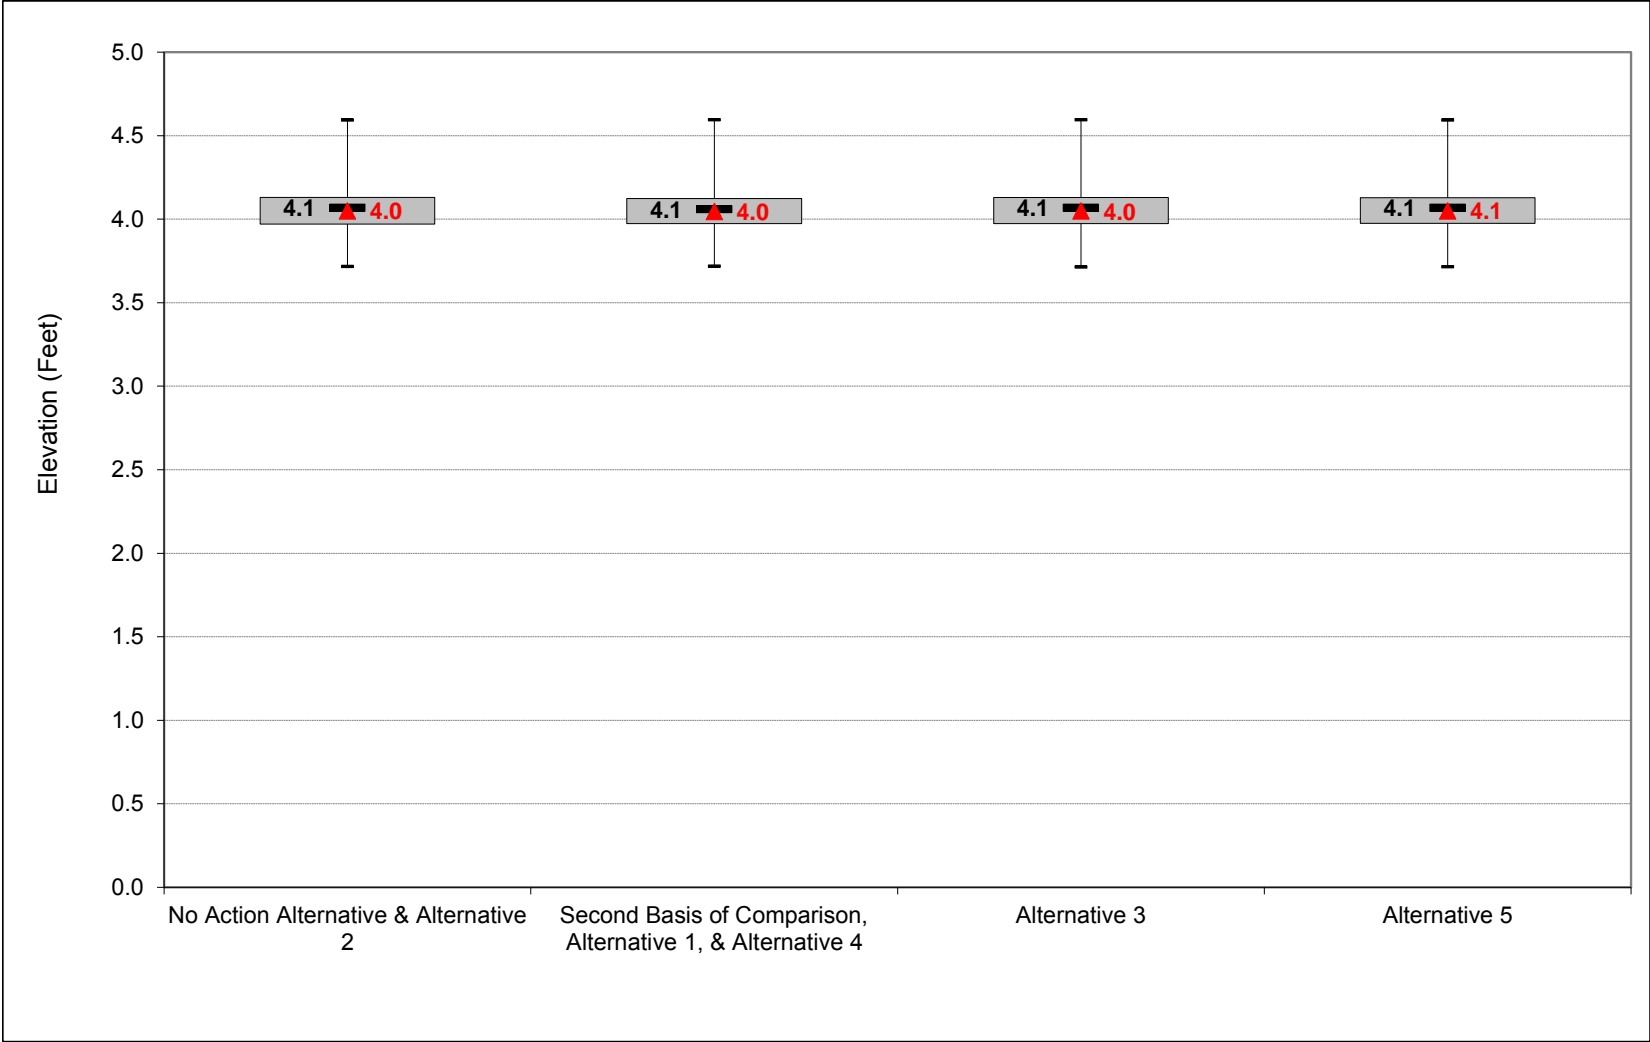

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-42-1-12. Mokelumne River at Terminous, Monthly Averaged Daily Maximum Elevation, September

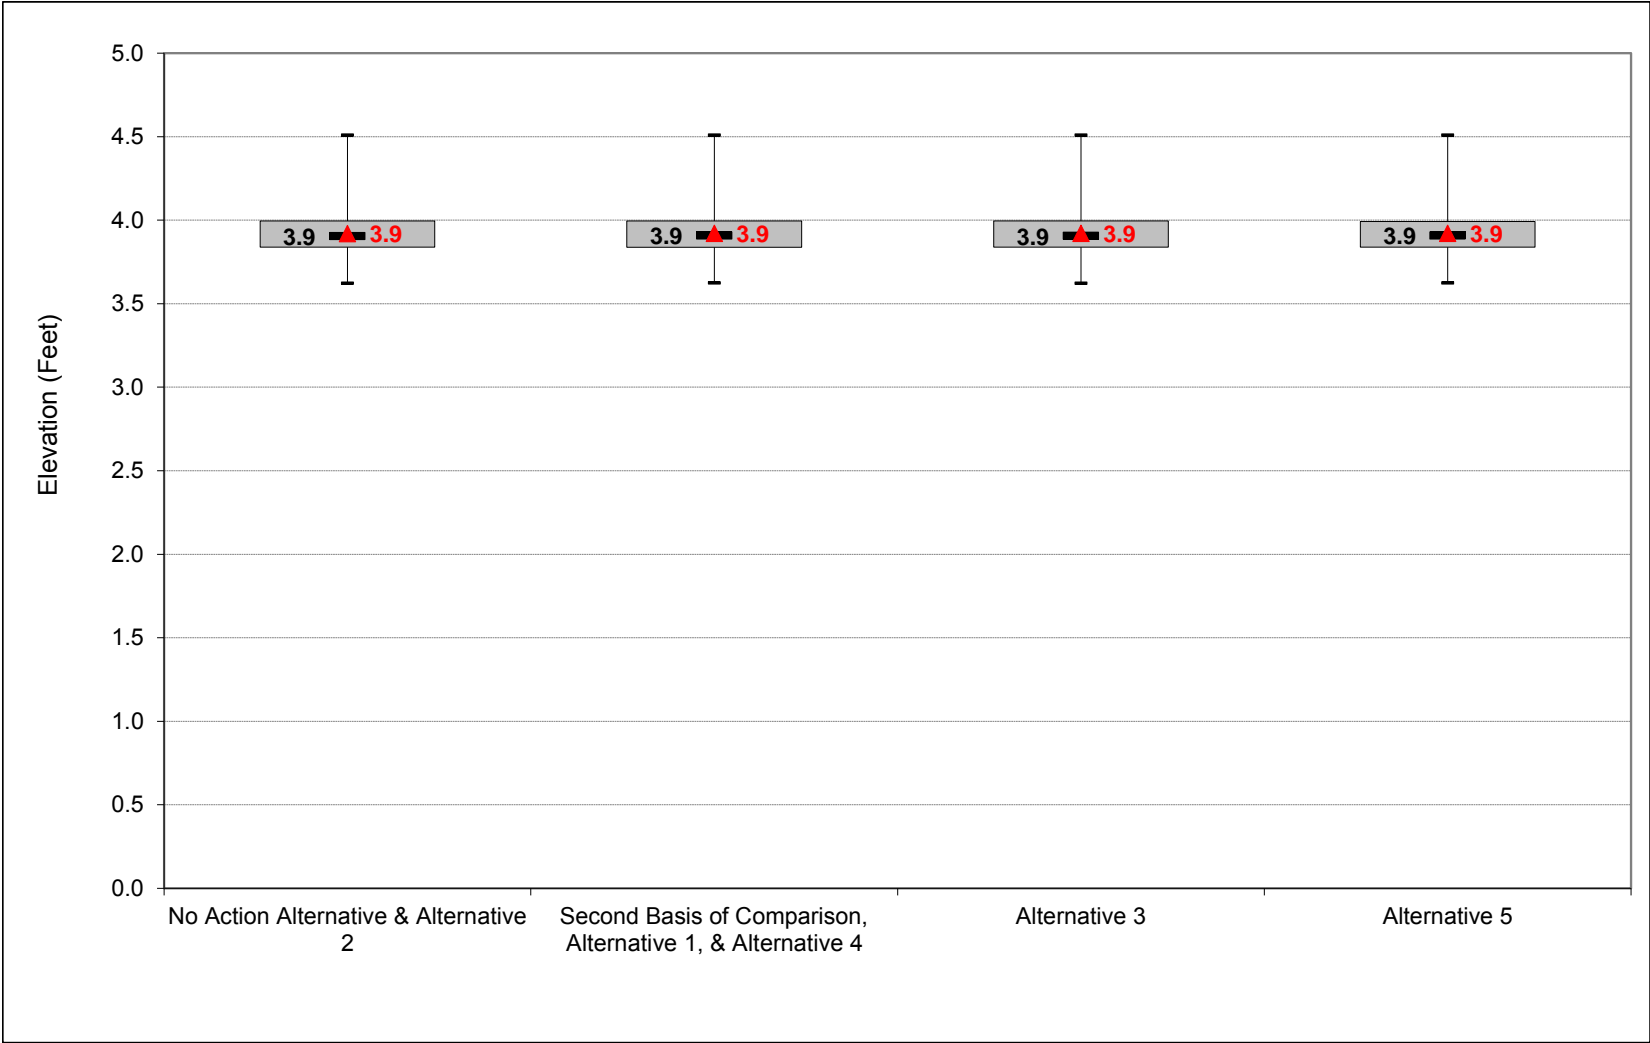

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-42-1-1. Mokelumne River at Terminous, Monthly Averaged Daily Maximum Elevation

No Action Alternative												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.7	3.9	4.3	4.6	4.6	4.2	3.9	4.0	4.1	4.2	4.1	4.0
20%	3.7	3.8	4.1	4.3	4.3	3.9	3.7	3.9	4.0	4.1	4.0	3.9
30%	3.6	3.7	3.9	4.1	4.1	3.7	3.6	3.8	4.0	4.1	4.0	3.9
40%	3.6	3.7	3.8	3.9	3.9	3.6	3.5	3.7	4.0	4.1	4.0	3.8
50%	3.6	3.6	3.8	3.8	3.8	3.5	3.4	3.7	3.9	4.1	3.9	3.8
60%	3.5	3.6	3.7	3.8	3.7	3.4	3.4	3.6	3.9	4.0	3.9	3.7
70%	3.5	3.5	3.7	3.7	3.6	3.4	3.3	3.6	3.8	4.0	3.8	3.7
80%	3.4	3.5	3.6	3.6	3.5	3.3	3.3	3.5	3.8	3.9	3.8	3.6
90%	3.4	3.4	3.5	3.5	3.4	3.2	3.2	3.4	3.7	3.9	3.8	3.6
Long Term												
Full Simulation Period ^b	3.6	3.6	3.8	3.9	3.9	3.6	3.5	3.7	3.9	4.0	3.9	3.8
Water Year Types ^c												
Wet (32%)	3.6	3.7	4.1	4.3	4.2	3.9	3.7	3.9	4.0	4.1	3.9	3.9
Above Normal (16%)	3.6	3.6	3.8	4.0	4.2	3.7	3.5	3.7	3.9	4.1	3.9	3.8
Below Normal (13%)	3.6	3.6	3.8	3.7	3.8	3.3	3.4	3.6	3.9	4.0	3.9	3.8
Dry (24%)	3.5	3.5	3.6	3.7	3.6	3.5	3.3	3.6	3.9	4.0	3.9	3.7
Critical (15%)	3.6	3.6	3.7	3.7	3.6	3.4	3.4	3.6	3.9	4.0	3.9	3.7

Alternative 1												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.8	3.9	4.3	4.6	4.6	4.2	3.9	4.0	4.2	4.2	4.1	3.9
20%	3.7	3.8	4.1	4.3	4.3	3.9	3.7	3.9	4.1	4.1	4.0	3.9
30%	3.6	3.7	3.9	4.0	4.1	3.7	3.6	3.8	4.0	4.1	4.0	3.9
40%	3.6	3.7	3.8	3.9	3.9	3.6	3.5	3.7	4.0	4.1	4.0	3.8
50%	3.5	3.6	3.8	3.8	3.8	3.5	3.4	3.6	3.9	4.1	3.9	3.8
60%	3.5	3.5	3.7	3.7	3.7	3.4	3.4	3.6	3.9	4.0	3.9	3.7
70%	3.5	3.5	3.7	3.7	3.6	3.4	3.3	3.5	3.8	4.0	3.8	3.7
80%	3.4	3.4	3.6	3.6	3.5	3.3	3.3	3.5	3.8	3.9	3.8	3.6
90%	3.4	3.4	3.5	3.5	3.4	3.2	3.2	3.4	3.7	3.9	3.8	3.6
Long Term												
Full Simulation Period ^b	3.6	3.6	3.8	3.9	3.9	3.6	3.5	3.7	3.9	4.0	3.9	3.8
Water Year Types ^c												
Wet (32%)	3.6	3.7	4.1	4.3	4.2	3.9	3.7	3.8	4.0	4.1	3.9	3.8
Above Normal (16%)	3.6	3.6	3.8	4.0	4.1	3.7	3.5	3.7	3.9	4.0	3.9	3.7
Below Normal (13%)	3.5	3.6	3.8	3.7	3.8	3.3	3.4	3.6	3.9	4.0	3.9	3.8
Dry (24%)	3.5	3.5	3.6	3.7	3.6	3.5	3.3	3.6	3.9	4.0	3.9	3.7
Critical (15%)	3.6	3.6	3.7	3.7	3.6	3.3	3.4	3.6	3.9	4.0	3.9	3.7

Alternative 1 minus No Action Alternative												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
30%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-42-1-2. Mokelumne River at Terminous, Monthly Averaged Daily Maximum Elevation

No Action Alternative

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.7	3.9	4.3	4.6	4.6	4.2	3.9	4.0	4.1	4.2	4.1	4.0
20%	3.7	3.8	4.1	4.3	4.3	3.9	3.7	3.9	4.0	4.1	4.0	3.9
30%	3.6	3.7	3.9	4.1	4.1	3.7	3.6	3.8	4.0	4.1	4.0	3.9
40%	3.6	3.7	3.8	3.9	3.9	3.6	3.5	3.7	4.0	4.1	4.0	3.8
50%	3.6	3.6	3.8	3.8	3.8	3.5	3.4	3.7	3.9	4.1	3.9	3.8
60%	3.5	3.6	3.7	3.8	3.7	3.4	3.4	3.6	3.9	4.0	3.9	3.7
70%	3.5	3.5	3.7	3.7	3.6	3.4	3.3	3.6	3.8	4.0	3.8	3.7
80%	3.4	3.5	3.6	3.6	3.5	3.3	3.3	3.5	3.8	3.9	3.8	3.6
90%	3.4	3.4	3.5	3.5	3.4	3.2	3.2	3.4	3.7	3.9	3.8	3.6
Long Term												
Full Simulation Period ^b	3.6	3.6	3.8	3.9	3.9	3.6	3.5	3.7	3.9	4.0	3.9	3.8
Water Year Types ^c												
Wet (32%)	3.6	3.7	4.1	4.3	4.2	3.9	3.7	3.9	4.0	4.1	3.9	3.9
Above Normal (16%)	3.6	3.6	3.8	4.0	4.2	3.7	3.5	3.7	3.9	4.1	3.9	3.8
Below Normal (13%)	3.6	3.6	3.8	3.7	3.8	3.3	3.4	3.6	3.9	4.0	3.9	3.8
Dry (24%)	3.5	3.5	3.6	3.7	3.6	3.5	3.3	3.6	3.9	4.0	3.9	3.7
Critical (15%)	3.6	3.6	3.7	3.7	3.6	3.4	3.4	3.6	3.9	4.0	3.9	3.7

Alternative 3

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.8	3.9	4.3	4.6	4.6	4.2	3.9	4.0	4.1	4.2	4.1	3.9
20%	3.7	3.8	4.2	4.3	4.3	3.9	3.7	3.9	4.0	4.1	4.0	3.9
30%	3.6	3.7	3.9	4.1	4.1	3.7	3.6	3.8	4.0	4.1	4.0	3.9
40%	3.6	3.6	3.8	3.9	3.9	3.6	3.5	3.7	4.0	4.1	4.0	3.8
50%	3.5	3.6	3.8	3.8	3.8	3.5	3.4	3.6	3.9	4.1	3.9	3.8
60%	3.5	3.5	3.7	3.8	3.7	3.4	3.4	3.6	3.9	4.0	3.9	3.7
70%	3.5	3.5	3.7	3.7	3.6	3.4	3.3	3.5	3.8	4.0	3.8	3.7
80%	3.4	3.4	3.6	3.6	3.5	3.3	3.2	3.5	3.8	3.9	3.8	3.6
90%	3.4	3.4	3.5	3.5	3.4	3.2	3.2	3.4	3.7	3.9	3.8	3.6
Long Term												
Full Simulation Period ^b	3.6	3.6	3.8	4.0	3.9	3.6	3.5	3.7	3.9	4.0	3.9	3.8
Water Year Types ^c												
Wet (32%)	3.6	3.7	4.1	4.3	4.2	3.9	3.7	3.8	4.0	4.1	3.9	3.8
Above Normal (16%)	3.6	3.6	3.8	4.1	4.2	3.7	3.5	3.7	3.9	4.0	3.9	3.7
Below Normal (13%)	3.5	3.6	3.8	3.8	3.8	3.3	3.4	3.6	3.9	4.0	3.9	3.8
Dry (24%)	3.5	3.5	3.6	3.7	3.6	3.5	3.3	3.6	3.9	4.0	3.9	3.7
Critical (15%)	3.6	3.6	3.7	3.7	3.6	3.4	3.4	3.6	3.9	4.0	3.9	3.7

Alternative 3 minus No Action Alternative

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
30%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-42-1-3. Mokelumne River at Terminous, Monthly Averaged Daily Maximum Elevation

No Action Alternative

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.7	3.9	4.3	4.6	4.6	4.2	3.9	4.0	4.1	4.2	4.1	4.0
20%	3.7	3.8	4.1	4.3	4.3	3.9	3.7	3.9	4.0	4.1	4.0	3.9
30%	3.6	3.7	3.9	4.1	4.1	3.7	3.6	3.8	4.0	4.1	4.0	3.9
40%	3.6	3.7	3.8	3.9	3.9	3.6	3.5	3.7	4.0	4.1	4.0	3.8
50%	3.6	3.6	3.8	3.8	3.8	3.5	3.4	3.7	3.9	4.1	3.9	3.8
60%	3.5	3.6	3.7	3.8	3.7	3.4	3.4	3.6	3.9	4.0	3.9	3.7
70%	3.5	3.5	3.7	3.7	3.6	3.4	3.3	3.6	3.8	4.0	3.8	3.7
80%	3.4	3.5	3.6	3.6	3.5	3.3	3.3	3.5	3.8	3.9	3.8	3.6
90%	3.4	3.4	3.5	3.5	3.4	3.2	3.2	3.4	3.7	3.9	3.8	3.6
Long Term												
Full Simulation Period ^b	3.6	3.6	3.8	3.9	3.9	3.6	3.5	3.7	3.9	4.0	3.9	3.8
Water Year Types ^c												
Wet (32%)	3.6	3.7	4.1	4.3	4.2	3.9	3.7	3.9	4.0	4.1	3.9	3.9
Above Normal (16%)	3.6	3.6	3.8	4.0	4.2	3.7	3.5	3.7	3.9	4.1	3.9	3.8
Below Normal (13%)	3.6	3.6	3.8	3.7	3.8	3.3	3.4	3.6	3.9	4.0	3.9	3.8
Dry (24%)	3.5	3.5	3.6	3.7	3.6	3.5	3.3	3.6	3.9	4.0	3.9	3.7
Critical (15%)	3.6	3.6	3.7	3.7	3.6	3.4	3.4	3.6	3.9	4.0	3.9	3.7

Alternative 5

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.7	3.9	4.3	4.6	4.6	4.2	3.9	4.0	4.1	4.2	4.1	4.0
20%	3.7	3.8	4.1	4.3	4.3	3.9	3.7	3.9	4.0	4.1	4.0	3.9
30%	3.6	3.7	3.9	4.1	4.1	3.7	3.6	3.8	4.0	4.1	4.0	3.9
40%	3.6	3.7	3.8	3.9	3.9	3.6	3.5	3.7	4.0	4.1	4.0	3.8
50%	3.6	3.6	3.8	3.8	3.8	3.5	3.5	3.7	3.9	4.1	3.9	3.8
60%	3.5	3.6	3.7	3.8	3.7	3.4	3.4	3.6	3.9	4.0	3.9	3.7
70%	3.5	3.5	3.7	3.7	3.6	3.4	3.3	3.6	3.8	4.0	3.8	3.7
80%	3.4	3.5	3.6	3.6	3.5	3.3	3.3	3.5	3.8	3.9	3.8	3.6
90%	3.4	3.4	3.5	3.5	3.4	3.2	3.2	3.4	3.7	3.9	3.8	3.6
Long Term												
Full Simulation Period ^b	3.6	3.6	3.8	3.9	3.9	3.6	3.5	3.7	3.9	4.1	3.9	3.8
Water Year Types ^c												
Wet (32%)	3.6	3.7	4.1	4.3	4.2	3.9	3.7	3.9	4.0	4.1	3.9	3.9
Above Normal (16%)	3.6	3.7	3.8	4.0	4.2	3.7	3.5	3.7	3.9	4.1	3.9	3.8
Below Normal (13%)	3.6	3.6	3.8	3.7	3.8	3.3	3.4	3.6	3.9	4.0	3.9	3.8
Dry (24%)	3.5	3.5	3.6	3.7	3.6	3.5	3.4	3.6	3.9	4.0	3.9	3.7
Critical (15%)	3.6	3.6	3.7	3.7	3.6	3.4	3.4	3.6	3.9	4.0	3.9	3.7

Alternative 5 minus No Action Alternative

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
30%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-42-1-4. Mokelumne River at Terminous, Monthly Averaged Daily Maximum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.8	3.9	4.3	4.6	4.6	4.2	3.9	4.0	4.2	4.2	4.1	3.9
20%	3.7	3.8	4.1	4.3	4.3	3.9	3.7	3.9	4.1	4.1	4.0	3.9
30%	3.6	3.7	3.9	4.0	4.1	3.7	3.6	3.8	4.0	4.1	4.0	3.9
40%	3.6	3.7	3.8	3.9	3.9	3.6	3.5	3.7	4.0	4.1	4.0	3.8
50%	3.5	3.6	3.8	3.8	3.8	3.5	3.4	3.6	3.9	4.1	3.9	3.8
60%	3.5	3.5	3.7	3.7	3.7	3.4	3.4	3.6	3.9	4.0	3.9	3.7
70%	3.5	3.5	3.7	3.7	3.6	3.4	3.3	3.5	3.8	4.0	3.8	3.7
80%	3.4	3.4	3.6	3.6	3.5	3.3	3.3	3.5	3.8	3.9	3.8	3.6
90%	3.4	3.4	3.5	3.5	3.4	3.2	3.2	3.4	3.7	3.9	3.8	3.6
Long Term												
Full Simulation Period ^b	3.6	3.6	3.8	3.9	3.9	3.6	3.5	3.7	3.9	4.0	3.9	3.8
Water Year Types ^c												
Wet (32%)	3.6	3.7	4.1	4.3	4.2	3.9	3.7	3.8	4.0	4.1	3.9	3.8
Above Normal (16%)	3.6	3.6	3.8	4.0	4.1	3.7	3.5	3.7	3.9	4.0	3.9	3.7
Below Normal (13%)	3.5	3.6	3.8	3.7	3.8	3.3	3.4	3.6	3.9	4.0	3.9	3.8
Dry (24%)	3.5	3.5	3.6	3.7	3.6	3.5	3.3	3.6	3.9	4.0	3.9	3.7
Critical (15%)	3.6	3.6	3.7	3.7	3.6	3.3	3.4	3.6	3.9	4.0	3.9	3.7

No Action Alternative

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.7	3.9	4.3	4.6	4.6	4.2	3.9	4.0	4.1	4.2	4.1	4.0
20%	3.7	3.8	4.1	4.3	4.3	3.9	3.7	3.9	4.0	4.1	4.0	3.9
30%	3.6	3.7	3.9	4.1	4.1	3.7	3.6	3.8	4.0	4.1	4.0	3.9
40%	3.6	3.7	3.8	3.9	3.9	3.6	3.5	3.7	4.0	4.1	4.0	3.8
50%	3.6	3.6	3.8	3.8	3.8	3.5	3.4	3.7	3.9	4.1	3.9	3.8
60%	3.5	3.6	3.7	3.8	3.7	3.4	3.4	3.6	3.9	4.0	3.9	3.7
70%	3.5	3.5	3.7	3.7	3.6	3.4	3.3	3.6	3.8	4.0	3.8	3.7
80%	3.4	3.5	3.6	3.6	3.5	3.3	3.3	3.5	3.8	3.9	3.8	3.6
90%	3.4	3.4	3.5	3.5	3.4	3.2	3.2	3.4	3.7	3.9	3.8	3.6
Long Term												
Full Simulation Period ^b	3.6	3.6	3.8	3.9	3.9	3.6	3.5	3.7	3.9	4.0	3.9	3.8
Water Year Types ^c												
Wet (32%)	3.6	3.7	4.1	4.3	4.2	3.9	3.7	3.9	4.0	4.1	3.9	3.9
Above Normal (16%)	3.6	3.6	3.8	4.0	4.2	3.7	3.5	3.7	3.9	4.1	3.9	3.8
Below Normal (13%)	3.6	3.6	3.8	3.7	3.8	3.3	3.4	3.6	3.9	4.0	3.9	3.8
Dry (24%)	3.5	3.5	3.6	3.7	3.6	3.5	3.3	3.6	3.9	4.0	3.9	3.7
Critical (15%)	3.6	3.6	3.7	3.7	3.6	3.4	3.4	3.6	3.9	4.0	3.9	3.7

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
30%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-42-1-5. Mokelumne River at Terminous, Monthly Averaged Daily Maximum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.8	3.9	4.3	4.6	4.6	4.2	3.9	4.0	4.2	4.2	4.1	3.9
20%	3.7	3.8	4.1	4.3	4.3	3.9	3.7	3.9	4.1	4.1	4.0	3.9
30%	3.6	3.7	3.9	4.0	4.1	3.7	3.6	3.8	4.0	4.1	4.0	3.9
40%	3.6	3.7	3.8	3.9	3.9	3.6	3.5	3.7	4.0	4.1	4.0	3.8
50%	3.5	3.6	3.8	3.8	3.8	3.5	3.4	3.6	3.9	4.1	3.9	3.8
60%	3.5	3.5	3.7	3.7	3.7	3.4	3.4	3.6	3.9	4.0	3.9	3.7
70%	3.5	3.5	3.7	3.7	3.6	3.4	3.3	3.5	3.8	4.0	3.8	3.7
80%	3.4	3.4	3.6	3.6	3.5	3.3	3.3	3.5	3.8	3.9	3.8	3.6
90%	3.4	3.4	3.5	3.5	3.4	3.2	3.2	3.4	3.7	3.9	3.8	3.6
Long Term												
Full Simulation Period ^b	3.6	3.6	3.8	3.9	3.9	3.6	3.5	3.7	3.9	4.0	3.9	3.8
Water Year Types ^c												
Wet (32%)	3.6	3.7	4.1	4.3	4.2	3.9	3.7	3.8	4.0	4.1	3.9	3.8
Above Normal (16%)	3.6	3.6	3.8	4.0	4.1	3.7	3.5	3.7	3.9	4.0	3.9	3.7
Below Normal (13%)	3.5	3.6	3.8	3.7	3.8	3.3	3.4	3.6	3.9	4.0	3.9	3.8
Dry (24%)	3.5	3.5	3.6	3.7	3.6	3.5	3.3	3.6	3.9	4.0	3.9	3.7
Critical (15%)	3.6	3.6	3.7	3.7	3.6	3.3	3.4	3.6	3.9	4.0	3.9	3.7

Alternative 3

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.8	3.9	4.3	4.6	4.6	4.2	3.9	4.0	4.1	4.2	4.1	3.9
20%	3.7	3.8	4.2	4.3	4.3	3.9	3.7	3.9	4.0	4.1	4.0	3.9
30%	3.6	3.7	3.9	4.1	4.1	3.7	3.6	3.8	4.0	4.1	4.0	3.9
40%	3.6	3.6	3.8	3.9	3.9	3.6	3.5	3.7	4.0	4.1	4.0	3.8
50%	3.5	3.6	3.8	3.8	3.8	3.5	3.4	3.6	3.9	4.1	3.9	3.8
60%	3.5	3.5	3.7	3.8	3.7	3.4	3.4	3.6	3.9	4.0	3.9	3.7
70%	3.5	3.5	3.7	3.7	3.6	3.4	3.3	3.5	3.8	4.0	3.8	3.7
80%	3.4	3.4	3.6	3.6	3.5	3.3	3.2	3.5	3.8	3.9	3.8	3.6
90%	3.4	3.4	3.5	3.5	3.4	3.2	3.2	3.4	3.7	3.9	3.8	3.6
Long Term												
Full Simulation Period ^b	3.6	3.6	3.8	4.0	3.9	3.6	3.5	3.7	3.9	4.0	3.9	3.8
Water Year Types ^c												
Wet (32%)	3.6	3.7	4.1	4.3	4.2	3.9	3.7	3.8	4.0	4.1	3.9	3.8
Above Normal (16%)	3.6	3.6	3.8	4.1	4.2	3.7	3.5	3.7	3.9	4.0	3.9	3.7
Below Normal (13%)	3.5	3.6	3.8	3.8	3.8	3.3	3.4	3.6	3.9	4.0	3.9	3.8
Dry (24%)	3.5	3.5	3.6	3.7	3.6	3.5	3.3	3.6	3.9	4.0	3.9	3.7
Critical (15%)	3.6	3.6	3.7	3.7	3.6	3.4	3.4	3.6	3.9	4.0	3.9	3.7

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
30%	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-42-1-6. Mokelumne River at Terminous, Monthly Averaged Daily Maximum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.8	3.9	4.3	4.6	4.6	4.2	3.9	4.0	4.2	4.2	4.1	3.9
20%	3.7	3.8	4.1	4.3	4.3	3.9	3.7	3.9	4.1	4.1	4.0	3.9
30%	3.6	3.7	3.9	4.0	4.1	3.7	3.6	3.8	4.0	4.1	4.0	3.9
40%	3.6	3.7	3.8	3.9	3.9	3.6	3.5	3.7	4.0	4.1	4.0	3.8
50%	3.5	3.6	3.8	3.8	3.8	3.5	3.4	3.6	3.9	4.1	3.9	3.8
60%	3.5	3.5	3.7	3.7	3.7	3.4	3.4	3.6	3.9	4.0	3.9	3.7
70%	3.5	3.5	3.7	3.7	3.6	3.4	3.3	3.5	3.8	4.0	3.8	3.7
80%	3.4	3.4	3.6	3.6	3.5	3.3	3.3	3.5	3.8	3.9	3.8	3.6
90%	3.4	3.4	3.5	3.5	3.4	3.2	3.2	3.4	3.7	3.9	3.8	3.6
Long Term												
Full Simulation Period ^b	3.6	3.6	3.8	3.9	3.9	3.6	3.5	3.7	3.9	4.0	3.9	3.8
Water Year Types ^c												
Wet (32%)	3.6	3.7	4.1	4.3	4.2	3.9	3.7	3.8	4.0	4.1	3.9	3.8
Above Normal (16%)	3.6	3.6	3.8	4.0	4.1	3.7	3.5	3.7	3.9	4.0	3.9	3.7
Below Normal (13%)	3.5	3.6	3.8	3.7	3.8	3.3	3.4	3.6	3.9	4.0	3.9	3.8
Dry (24%)	3.5	3.5	3.6	3.7	3.6	3.5	3.3	3.6	3.9	4.0	3.9	3.7
Critical (15%)	3.6	3.6	3.7	3.7	3.6	3.3	3.4	3.6	3.9	4.0	3.9	3.7

Alternative 5

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.7	3.9	4.3	4.6	4.6	4.2	3.9	4.0	4.1	4.2	4.1	4.0
20%	3.7	3.8	4.1	4.3	4.3	3.9	3.7	3.9	4.0	4.1	4.0	3.9
30%	3.6	3.7	3.9	4.1	4.1	3.7	3.6	3.8	4.0	4.1	4.0	3.9
40%	3.6	3.7	3.8	3.9	3.9	3.6	3.5	3.7	4.0	4.1	4.0	3.8
50%	3.6	3.6	3.8	3.8	3.8	3.5	3.5	3.7	3.9	4.1	3.9	3.8
60%	3.5	3.6	3.7	3.8	3.7	3.4	3.4	3.6	3.9	4.0	3.9	3.7
70%	3.5	3.5	3.7	3.7	3.6	3.4	3.3	3.6	3.8	4.0	3.8	3.7
80%	3.4	3.5	3.6	3.6	3.5	3.3	3.3	3.5	3.8	3.9	3.8	3.6
90%	3.4	3.4	3.5	3.5	3.4	3.2	3.2	3.4	3.7	3.9	3.8	3.6
Long Term												
Full Simulation Period ^b	3.6	3.6	3.8	3.9	3.9	3.6	3.5	3.7	3.9	4.1	3.9	3.8
Water Year Types ^c												
Wet (32%)	3.6	3.7	4.1	4.3	4.2	3.9	3.7	3.9	4.0	4.1	3.9	3.9
Above Normal (16%)	3.6	3.7	3.8	4.0	4.2	3.7	3.5	3.7	3.9	4.1	3.9	3.8
Below Normal (13%)	3.6	3.6	3.8	3.7	3.8	3.3	3.4	3.6	3.9	4.0	3.9	3.8
Dry (24%)	3.5	3.5	3.6	3.7	3.6	3.5	3.4	3.6	3.9	4.0	3.9	3.7
Critical (15%)	3.6	3.6	3.7	3.7	3.6	3.4	3.4	3.6	3.9	4.0	3.9	3.7

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
30%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0


a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-42-2-1. Mokelumne River at Terminous, Monthly Averaged Daily Minimum Elevation, October

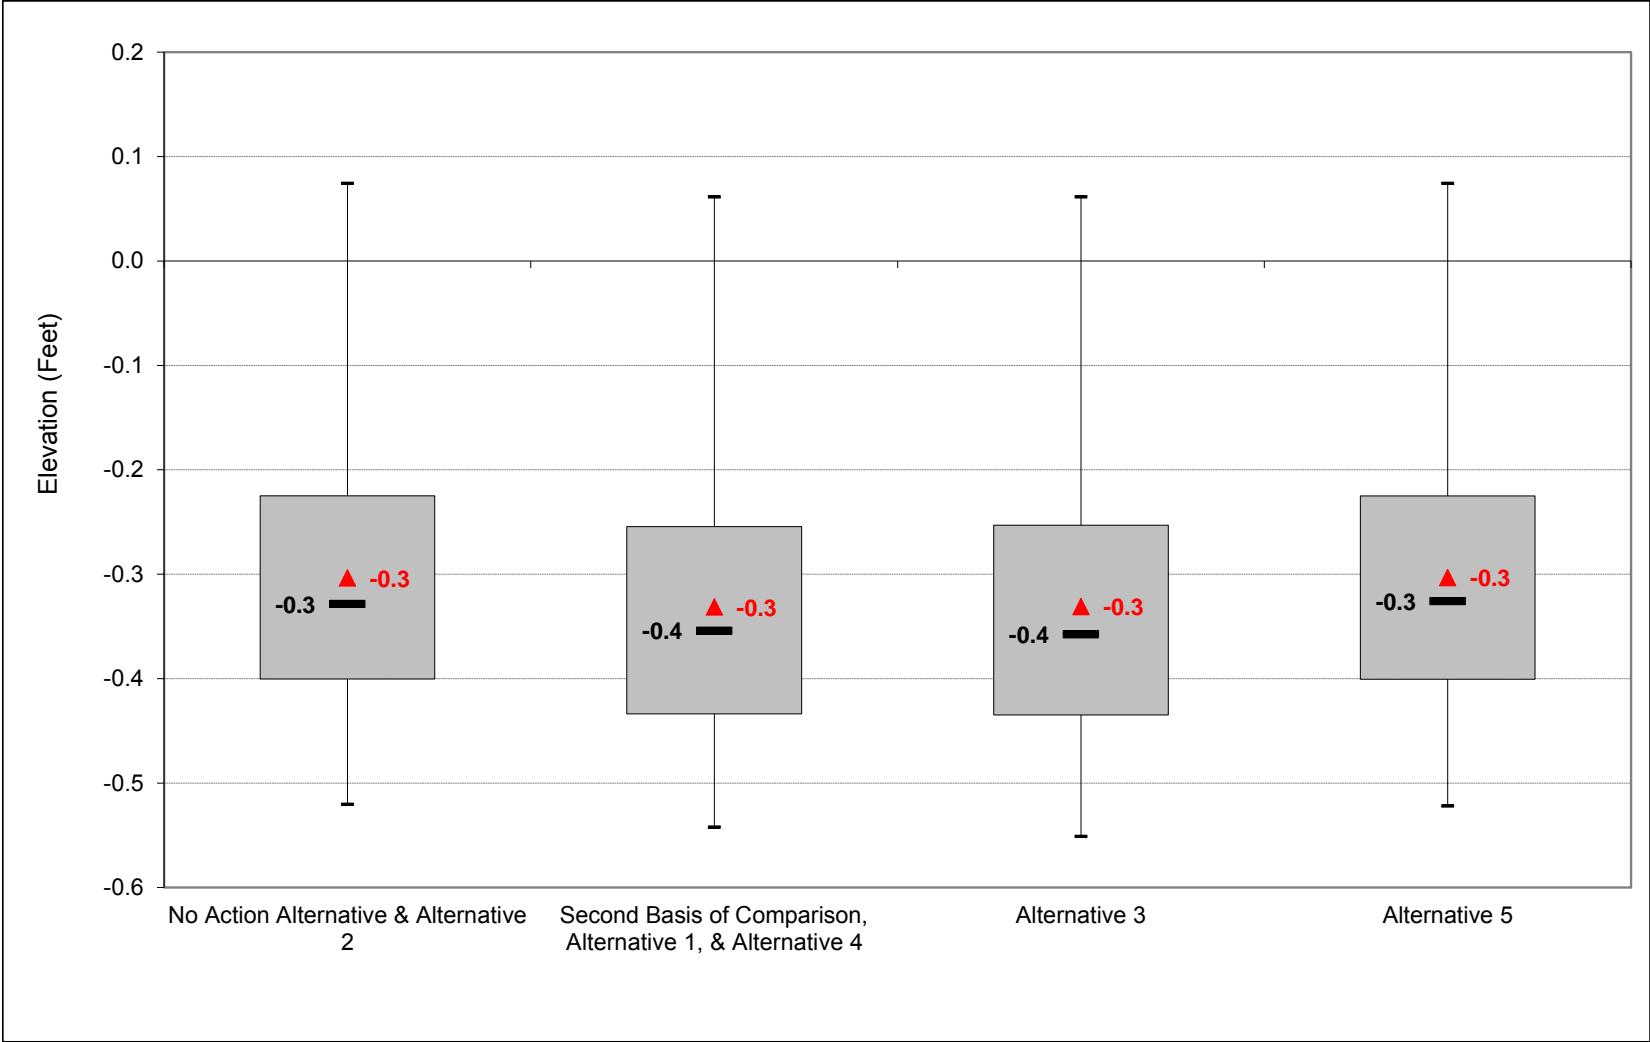


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-42-2-2. Mokelumne River at Terminous, Monthly Averaged Daily Minimum Elevation, November

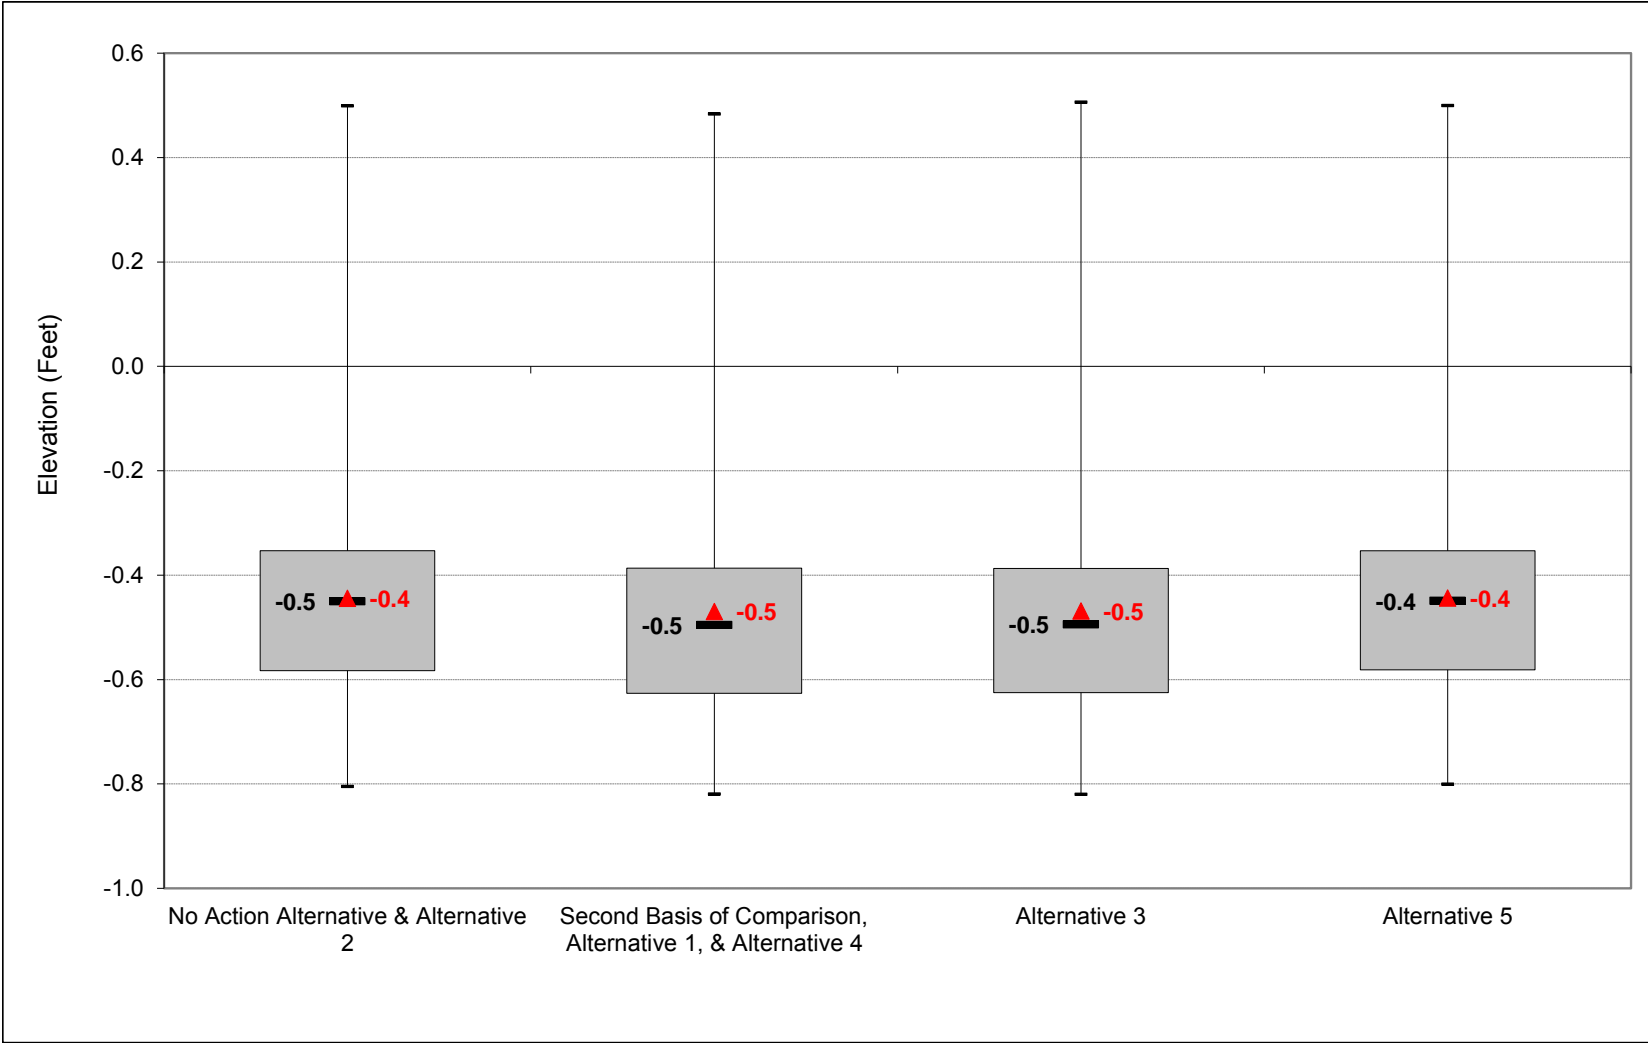


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-42-2-3. Mokelumne River at Terminous, Monthly Averaged Daily Minimum Elevation, December

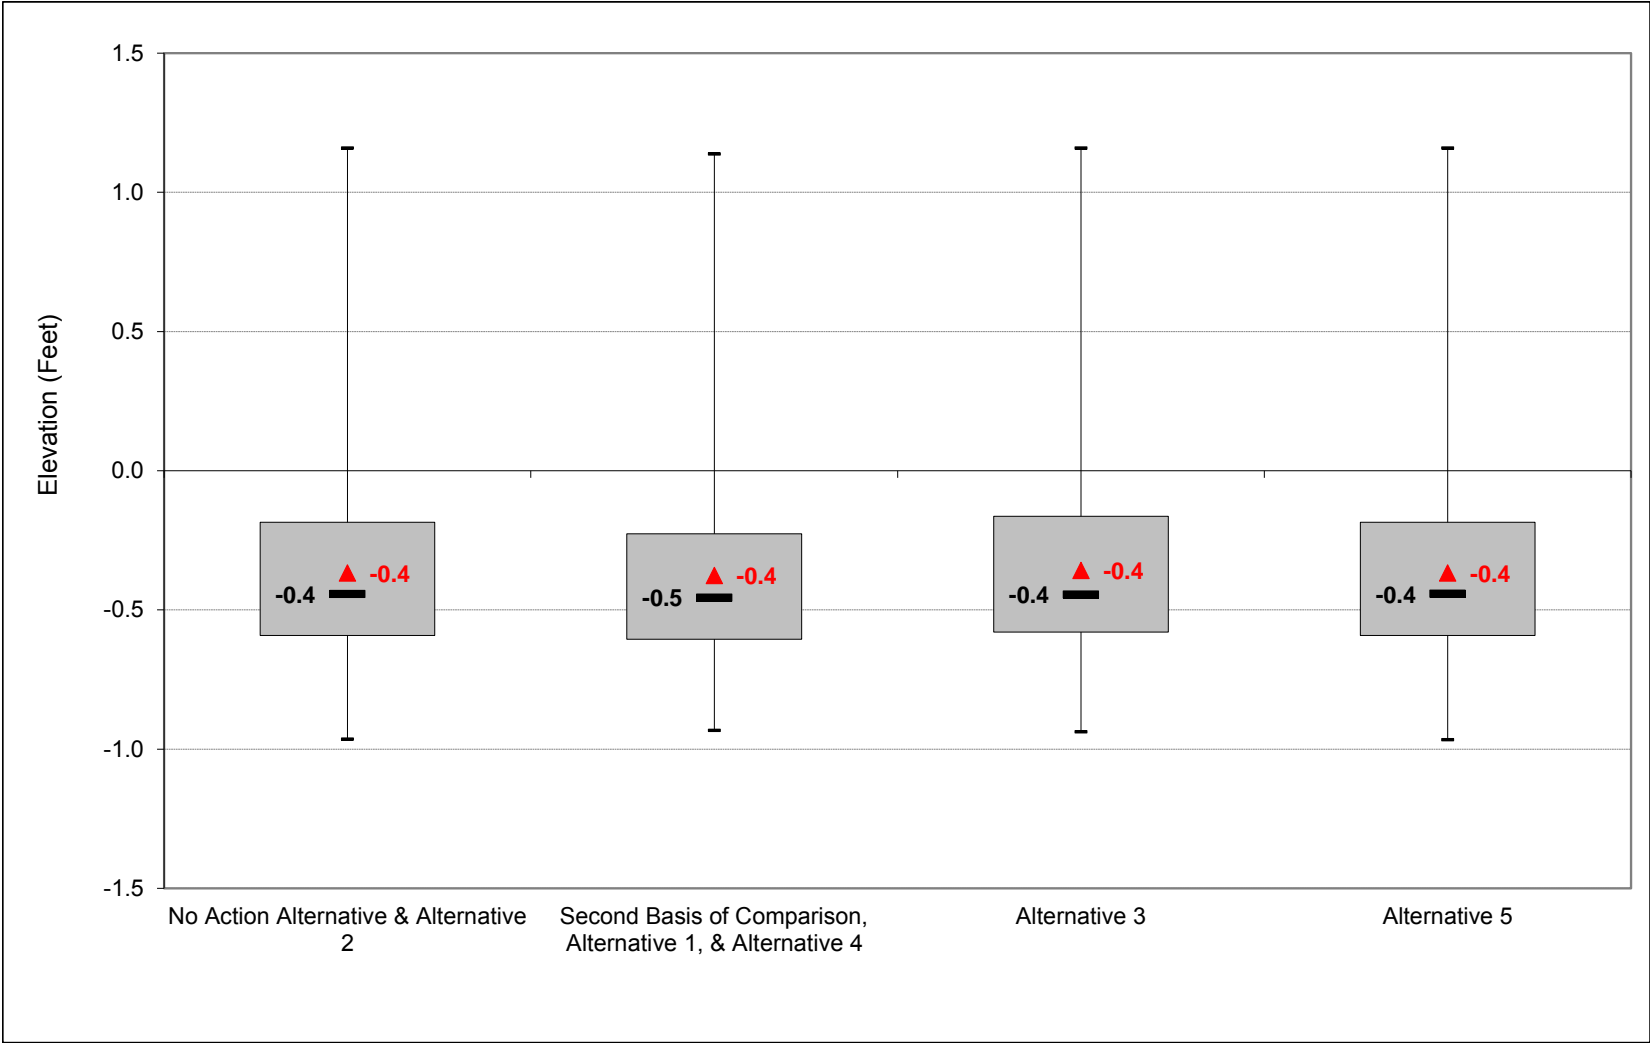


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-42-2-4. Mokelumne River at Terminous, Monthly Averaged Daily Minimum Elevation, January

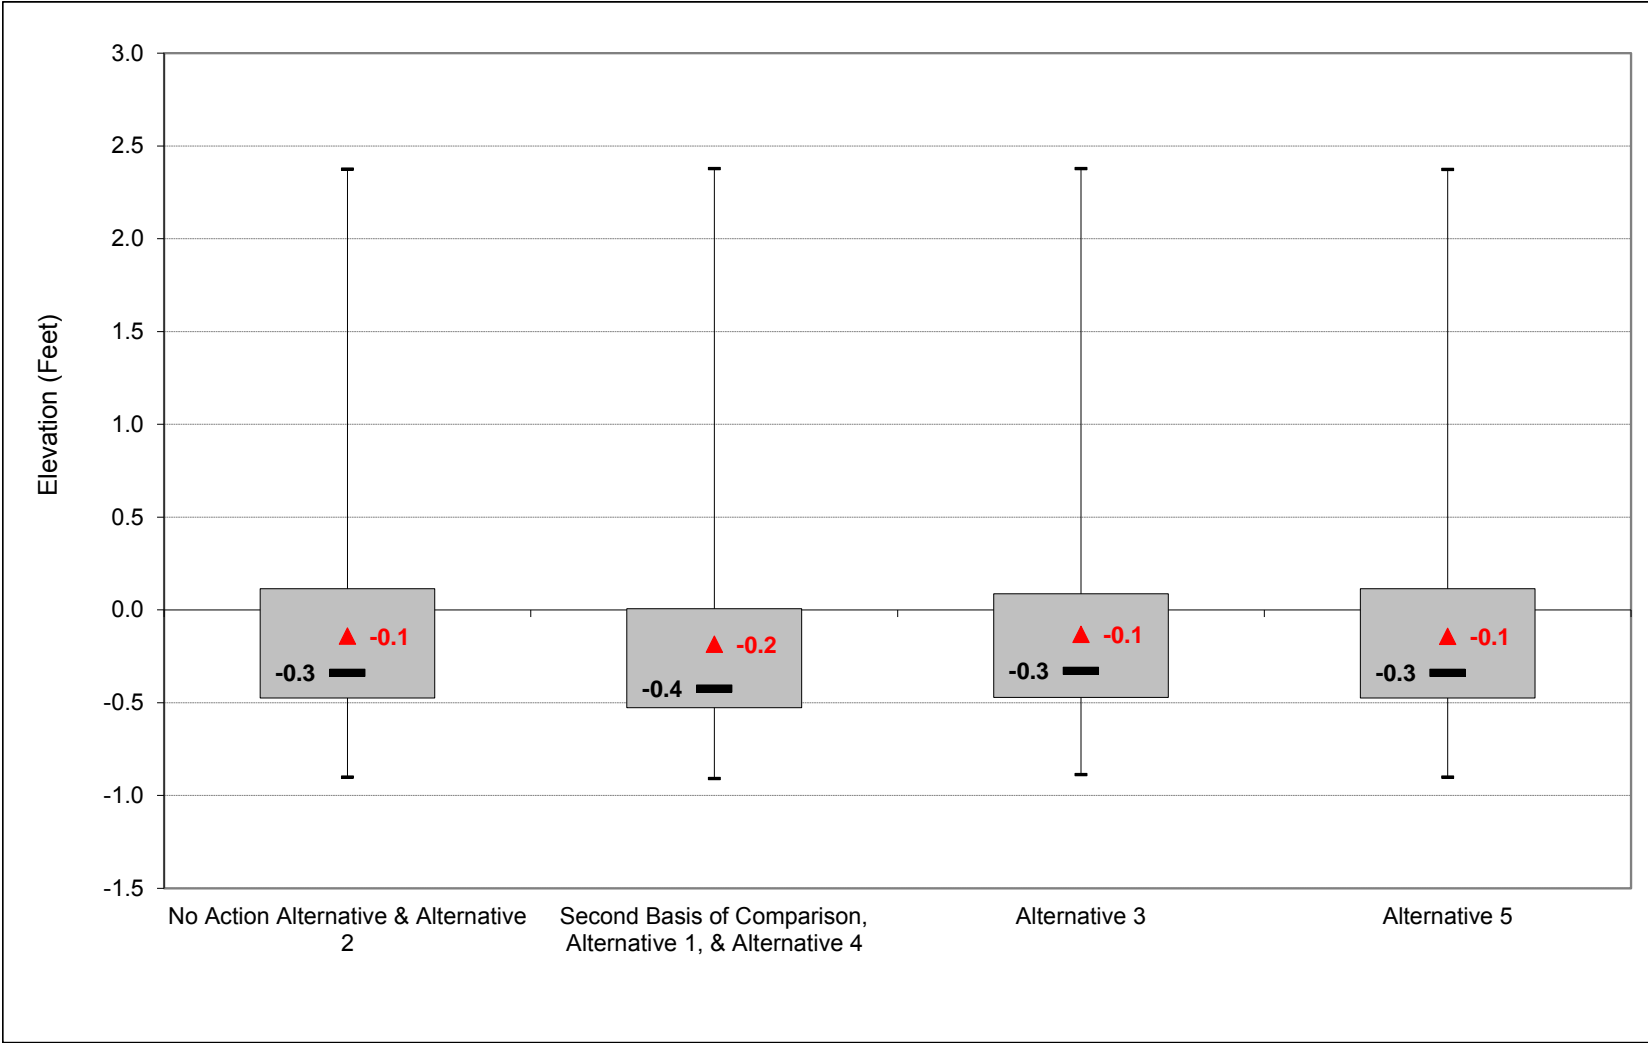


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-42-2-5. Mokelumne River at Terminous, Monthly Averaged Daily Minimum Elevation, February

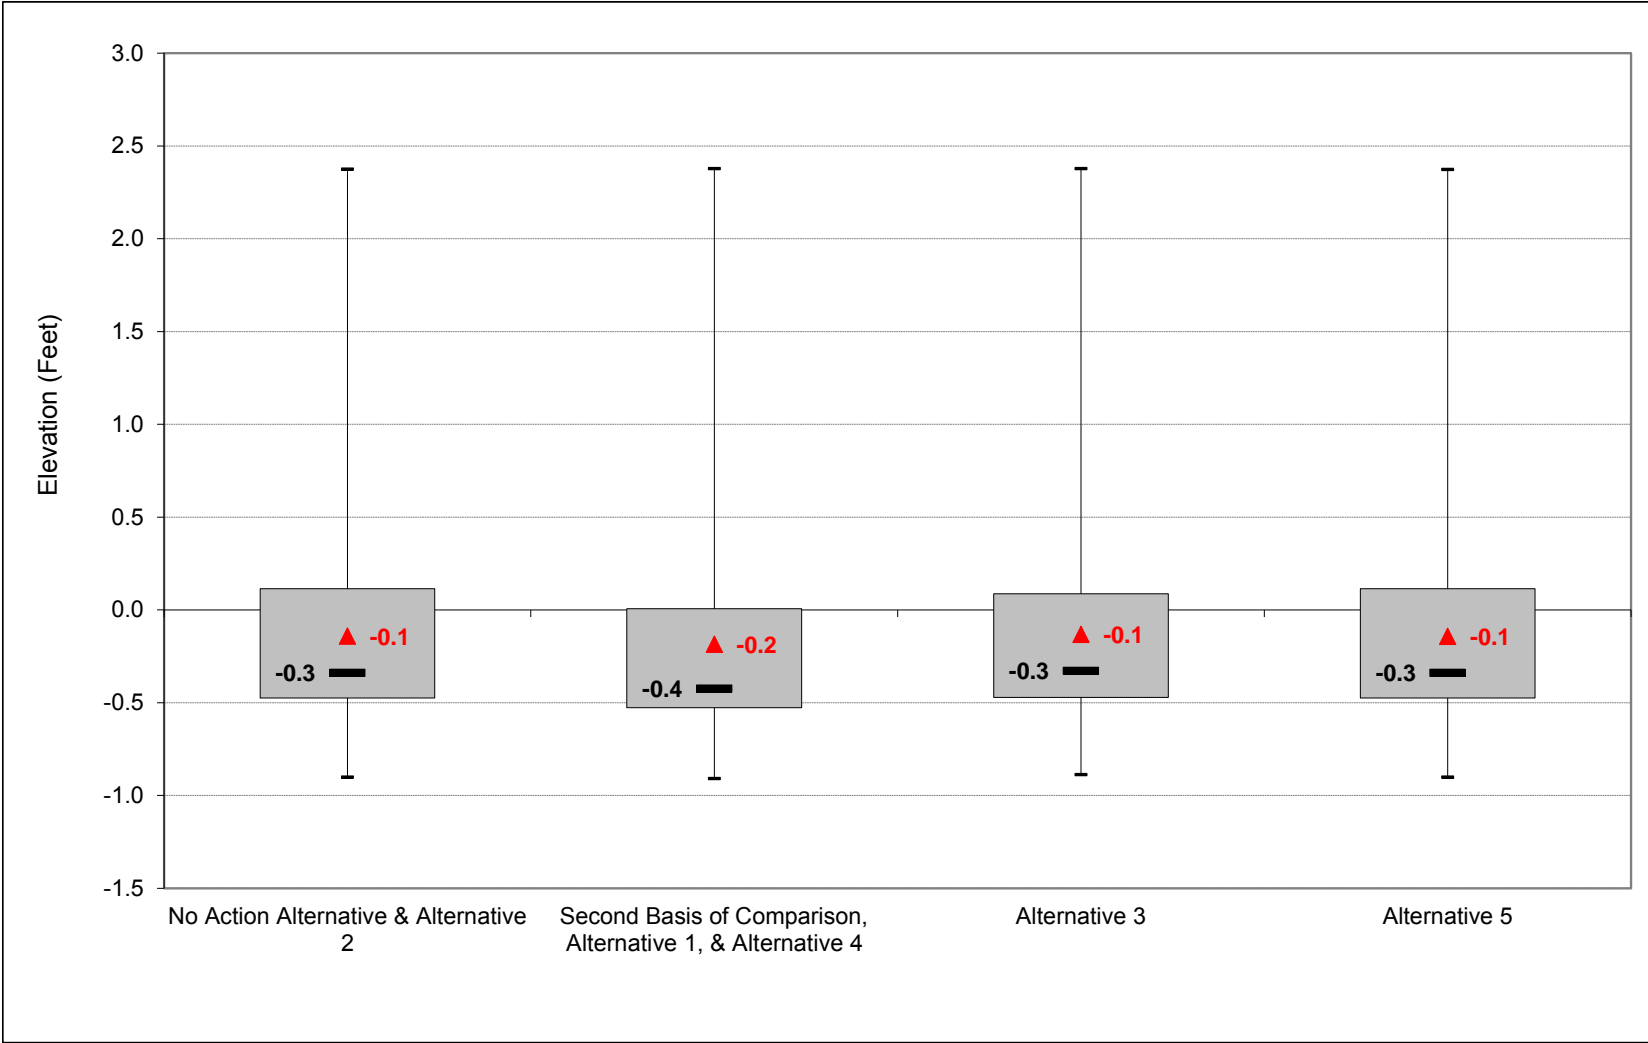


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-42-2-6. Mokelumne River at Terminous, Monthly Averaged Daily Minimum Elevation, March

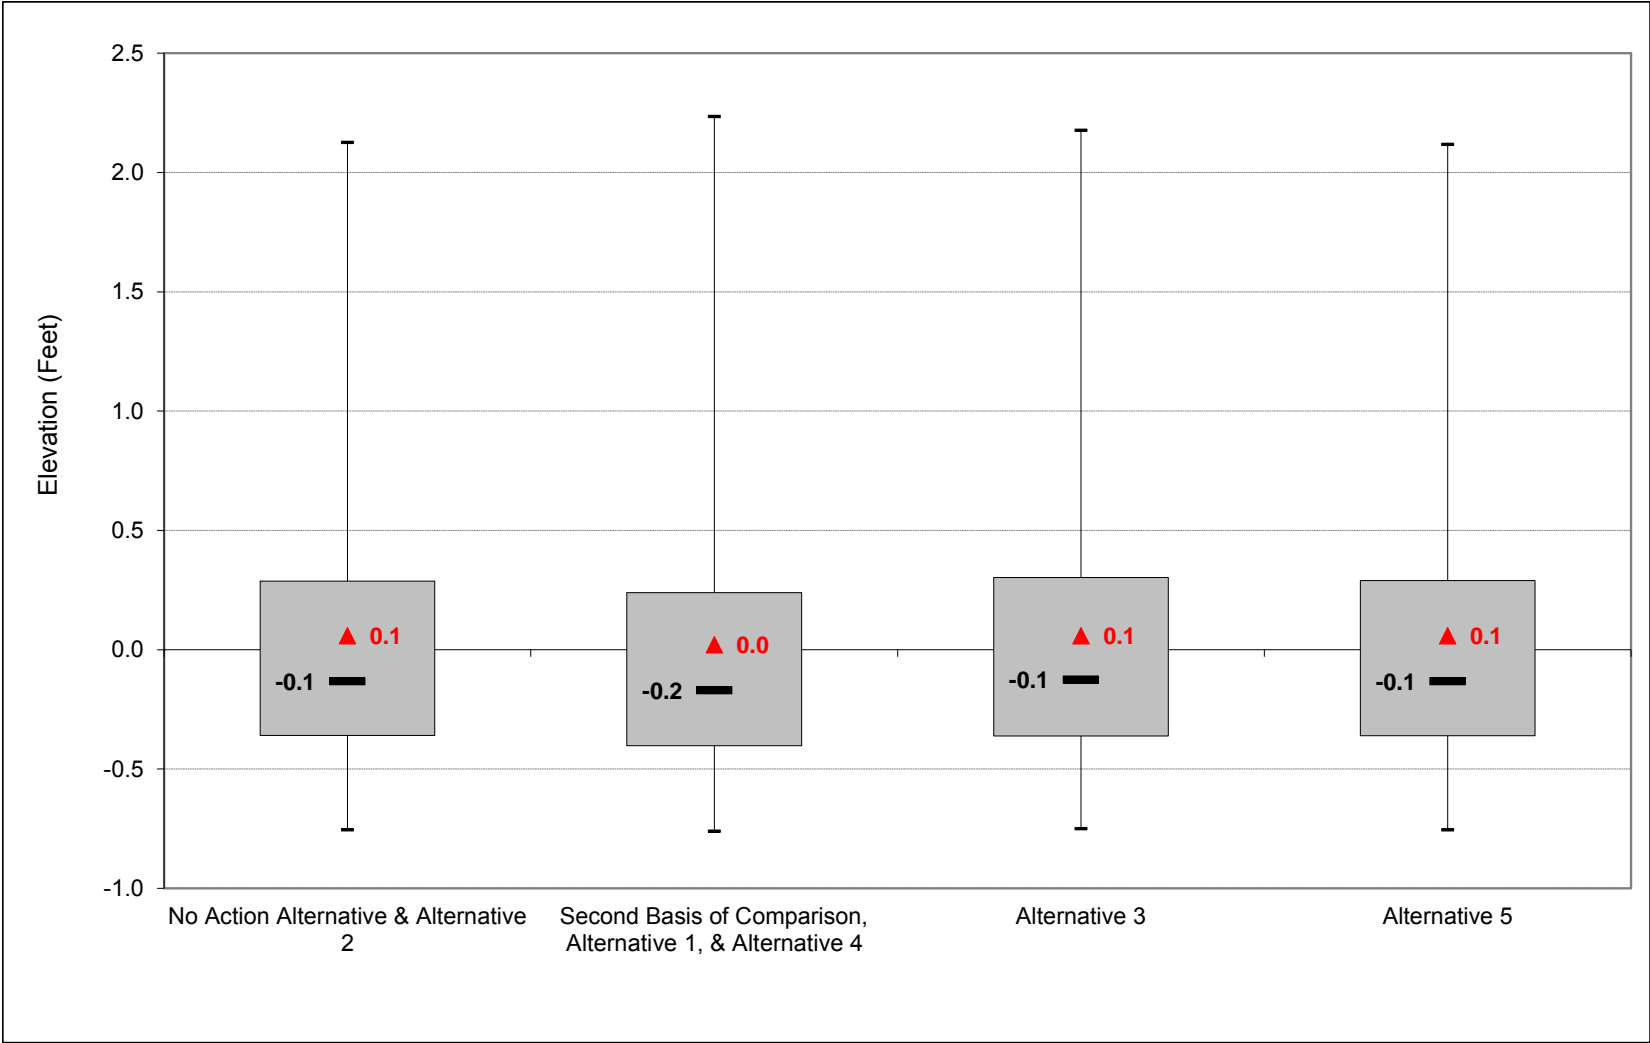


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-42-2-7. Mokelumne River at Terminous, Monthly Averaged Daily Minimum Elevation, April

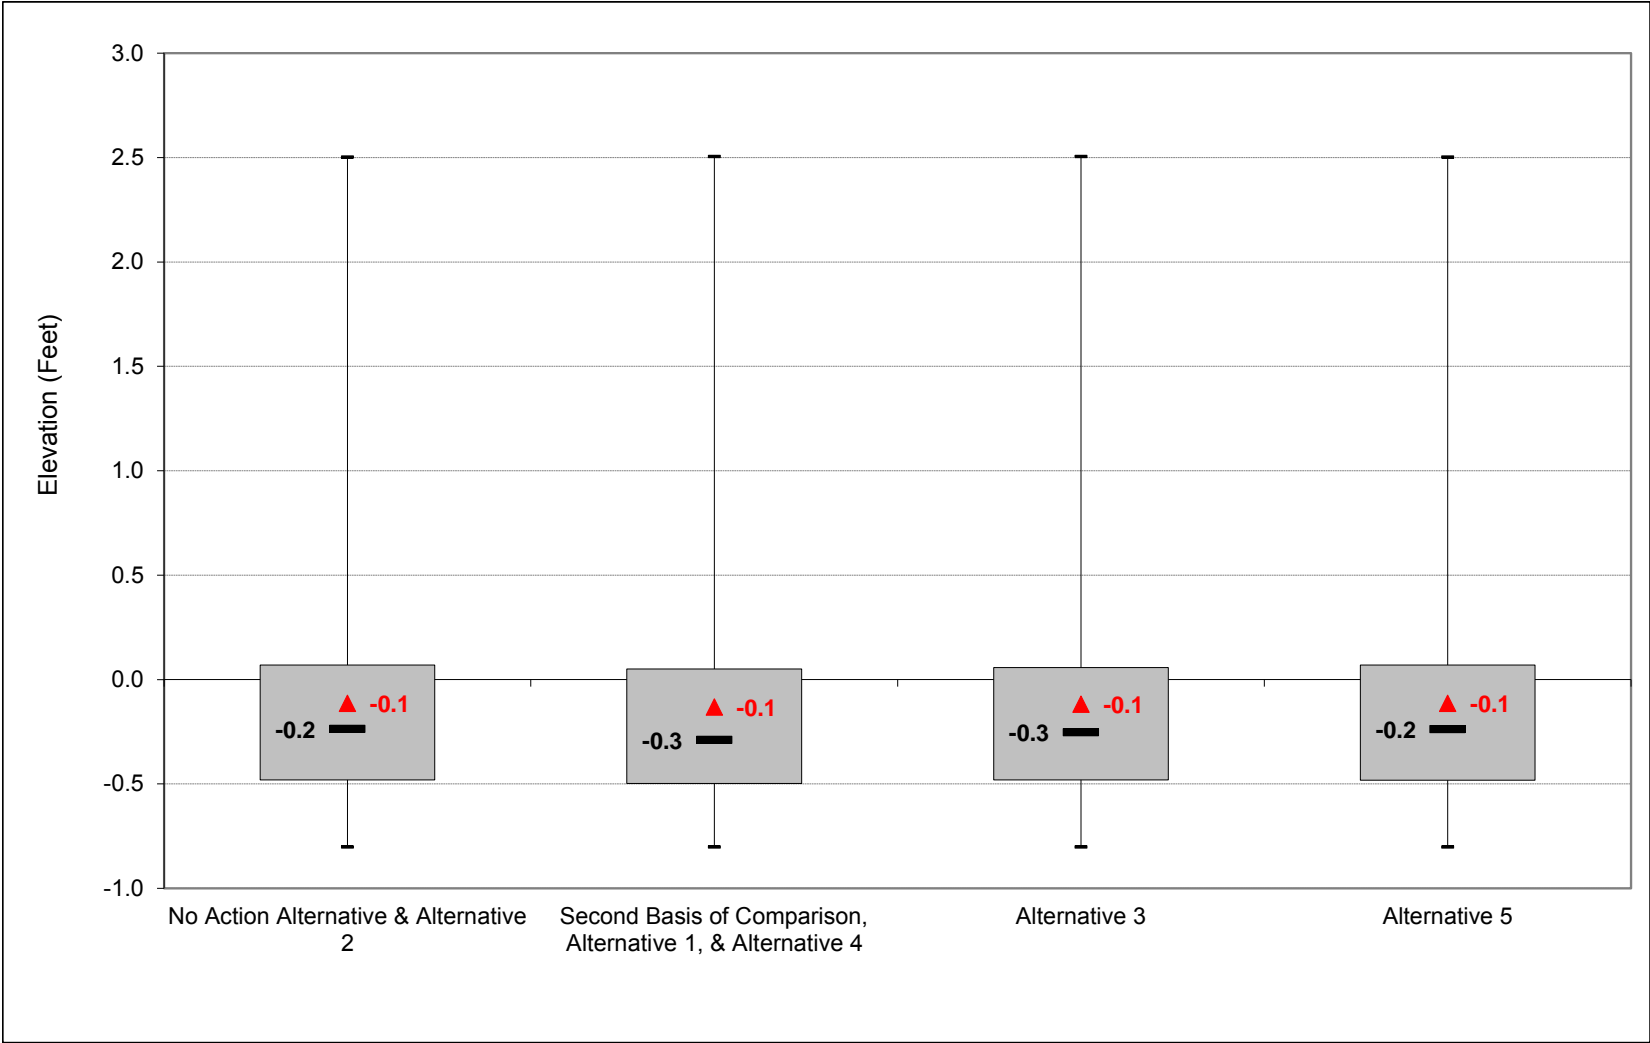


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-42-2-8. Mokelumne River at Terminous, Monthly Averaged Daily Minimum Elevation, May

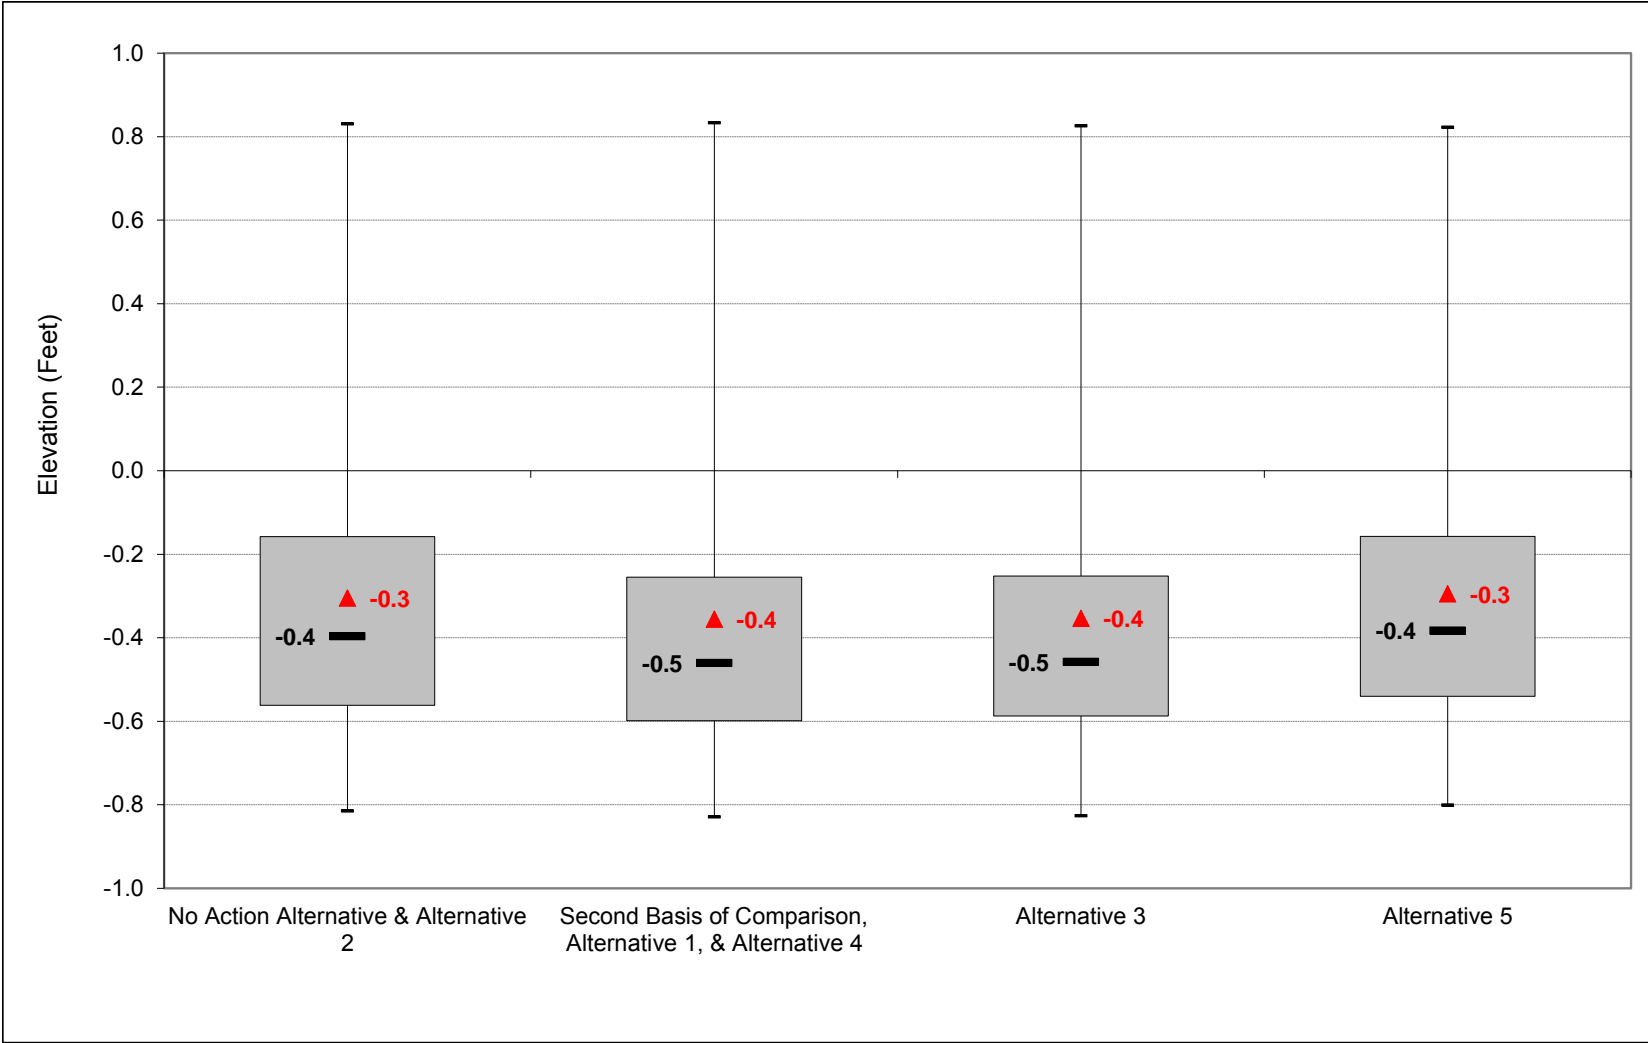


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-42-2-9. Mokelumne River at Terminous, Monthly Averaged Daily Minimum Elevation, June

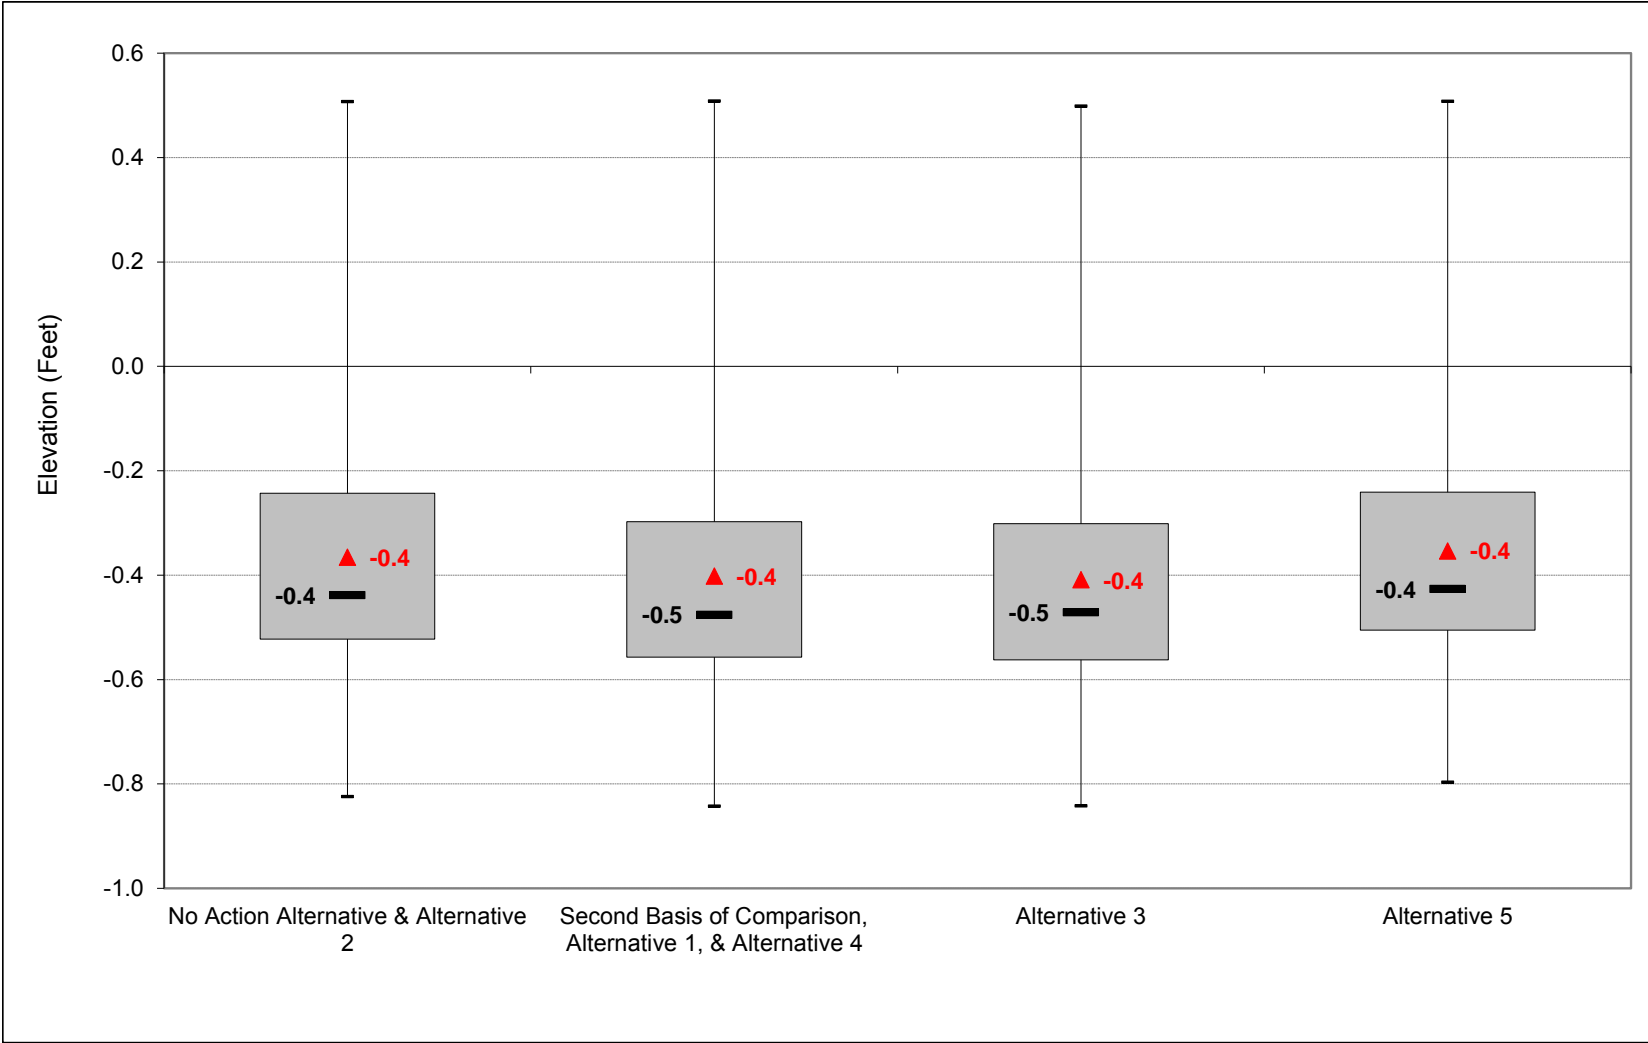


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-42-2-10. Mokelumne River at Terminous, Monthly Averaged Daily Minimum Elevation, July

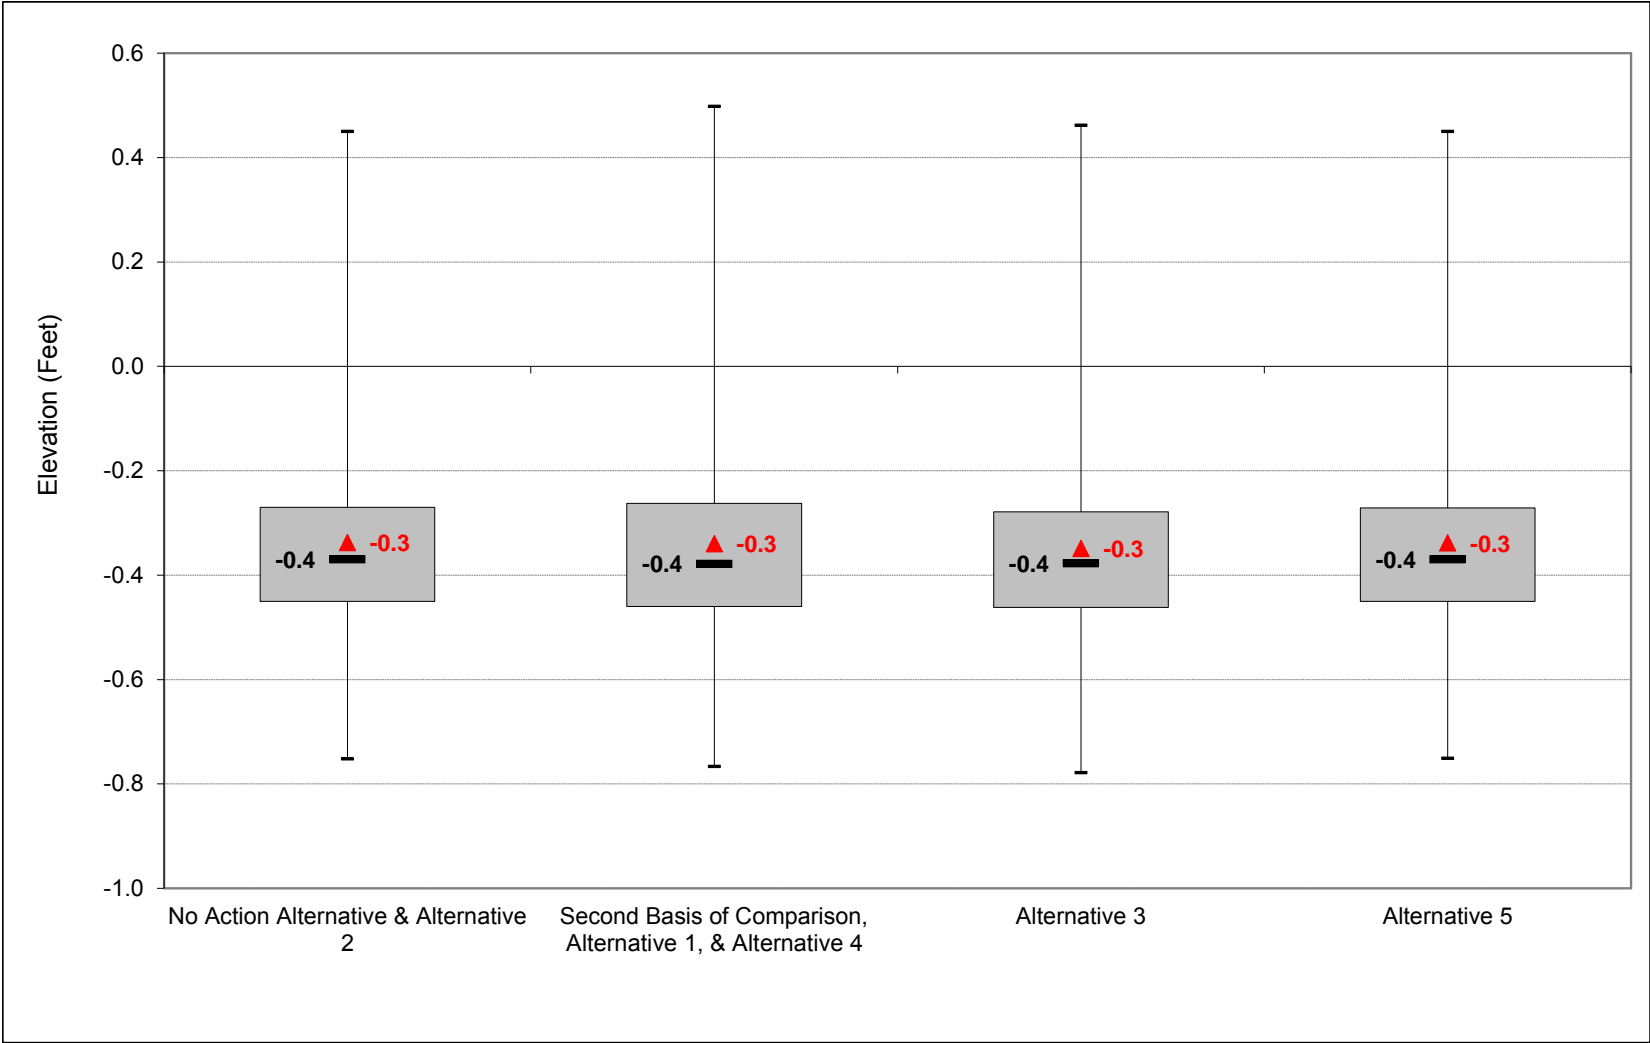


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-42-2-11. Mokelumne River at Terminous, Monthly Averaged Daily Minimum Elevation, August

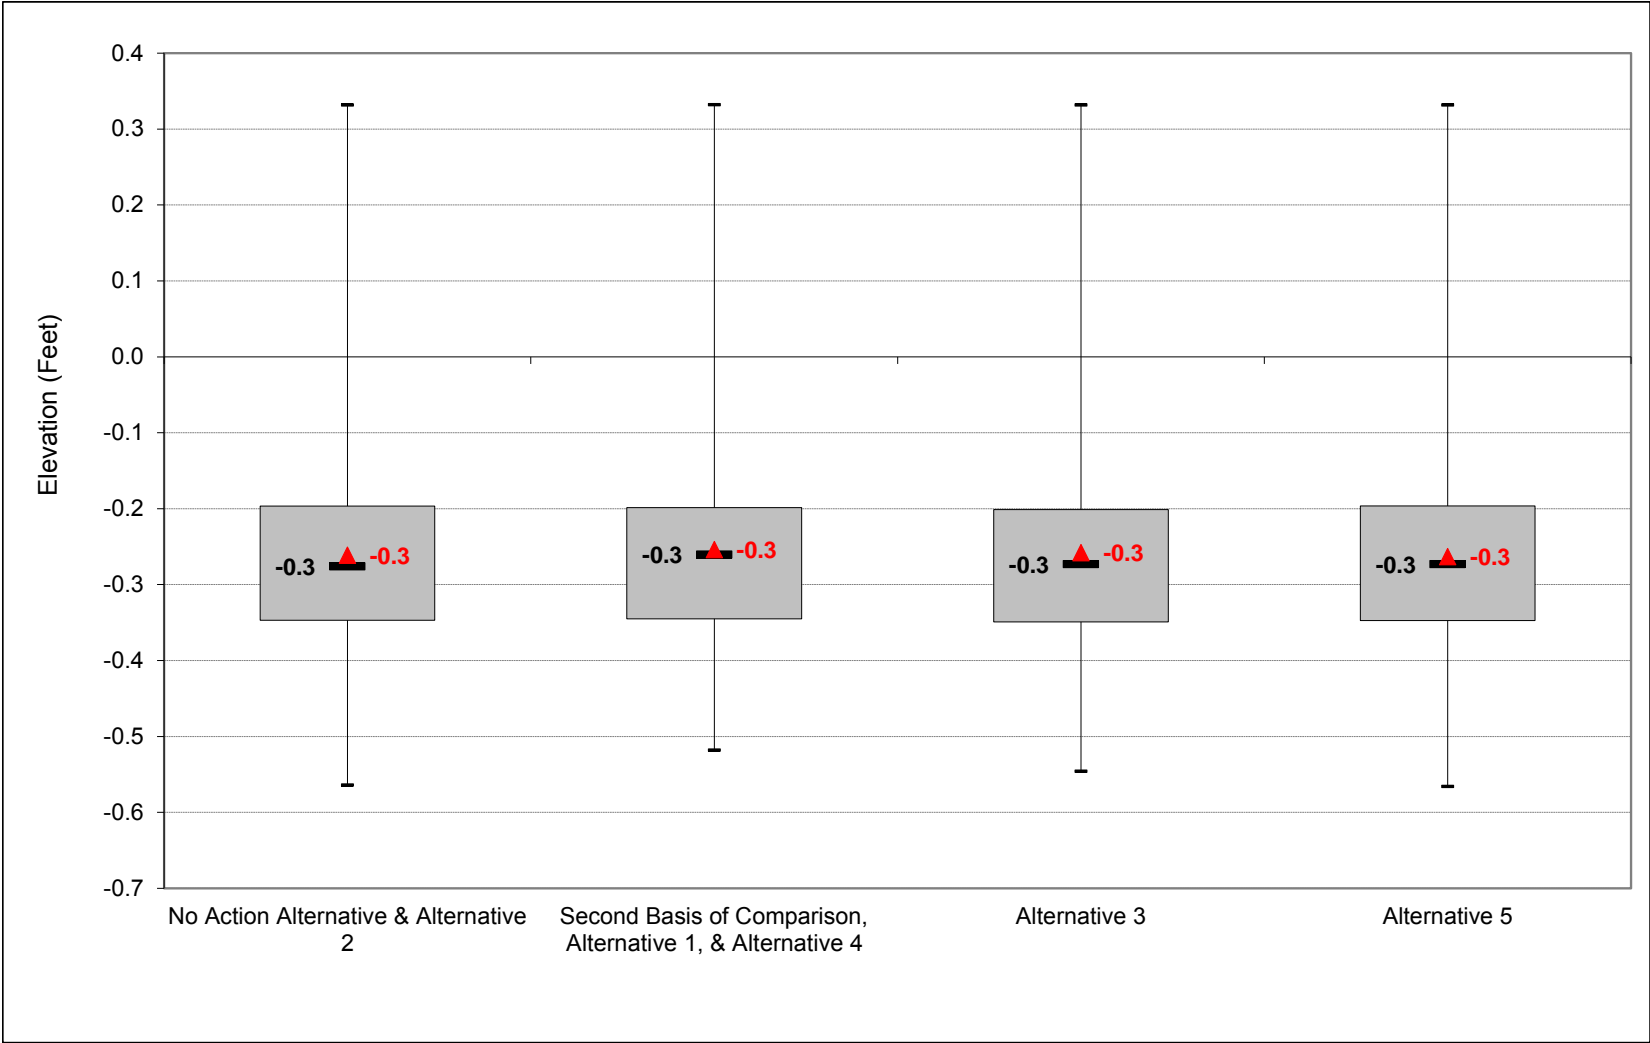

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-42-2-12. Mokelumne River at Terminous, Monthly Averaged Daily Minimum Elevation, September

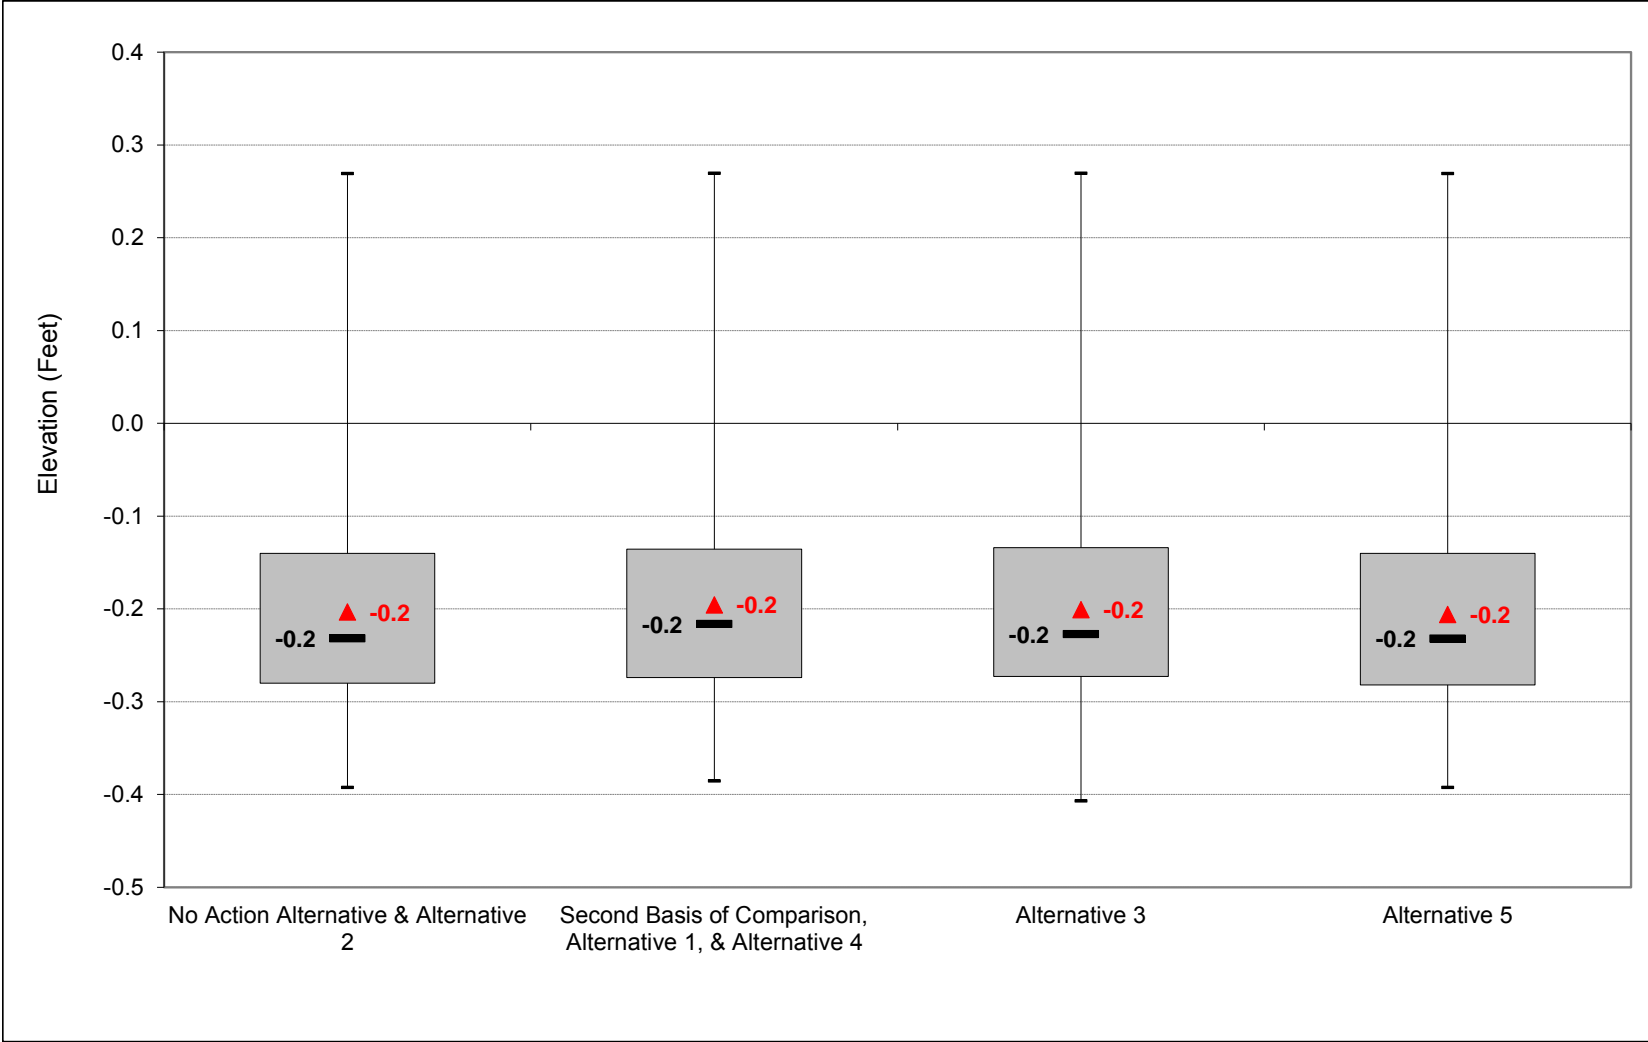

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-42-2-1. Mokelumne River at Terminous, Monthly Averaged Daily Minimum Elevation

No Action Alternative												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.1	-0.3	0.2	0.5	0.9	0.5	0.2	0.0	-0.1	-0.1	-0.1	0.0
20%	-0.2	-0.3	-0.1	0.3	0.4	0.1	0.0	-0.2	-0.2	-0.2	-0.1	0.0
30%	-0.2	-0.4	-0.3	-0.1	0.2	-0.1	-0.2	-0.3	-0.3	-0.2	-0.2	-0.1
40%	-0.3	-0.4	-0.4	-0.3	0.1	-0.2	-0.3	-0.4	-0.3	-0.3	-0.2	-0.1
50%	-0.3	-0.5	-0.4	-0.3	-0.1	-0.2	-0.4	-0.4	-0.4	-0.3	-0.2	-0.1
60%	-0.4	-0.5	-0.5	-0.4	-0.2	-0.3	-0.5	-0.5	-0.4	-0.3	-0.3	-0.2
70%	-0.4	-0.5	-0.6	-0.5	-0.3	-0.4	-0.5	-0.5	-0.4	-0.3	-0.3	-0.2
80%	-0.4	-0.6	-0.6	-0.5	-0.4	-0.5	-0.6	-0.5	-0.5	-0.4	-0.3	-0.3
90%	-0.5	-0.6	-0.7	-0.6	-0.5	-0.6	-0.6	-0.6	-0.5	-0.4	-0.3	-0.3
Long Term												
Full Simulation Period ^b	-0.3	-0.4	-0.4	-0.1	0.1	-0.1	-0.3	-0.4	-0.3	-0.3	-0.2	-0.1
Water Year Types ^c												
Wet (32%)	-0.3	-0.4	-0.1	0.3	0.5	0.3	0.0	-0.2	-0.2	-0.2	-0.2	0.0
Above Normal (16%)	-0.3	-0.4	-0.4	-0.1	0.3	-0.1	-0.3	-0.3	-0.4	-0.3	-0.2	-0.2
Below Normal (13%)	-0.3	-0.5	-0.5	-0.4	-0.2	-0.4	-0.4	-0.5	-0.4	-0.3	-0.2	-0.1
Dry (24%)	-0.3	-0.5	-0.6	-0.5	-0.3	-0.3	-0.5	-0.5	-0.4	-0.3	-0.2	-0.2
Critical (15%)	-0.3	-0.5	-0.5	-0.5	-0.3	-0.5	-0.5	-0.6	-0.4	-0.3	-0.2	-0.2

Alternative 1												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.1	-0.3	0.1	0.5	0.9	0.6	0.1	0.0	-0.1	-0.1	0.0	0.0
20%	-0.2	-0.4	-0.1	0.2	0.4	0.1	0.0	-0.2	-0.2	-0.2	-0.1	-0.1
30%	-0.3	-0.4	-0.3	-0.2	0.2	-0.1	-0.3	-0.3	-0.3	-0.2	-0.1	-0.1
40%	-0.3	-0.4	-0.4	-0.3	0.1	-0.2	-0.4	-0.4	-0.3	-0.2	-0.2	-0.1
50%	-0.4	-0.5	-0.5	-0.4	-0.2	-0.3	-0.5	-0.5	-0.4	-0.3	-0.2	-0.2
60%	-0.4	-0.5	-0.5	-0.5	-0.3	-0.4	-0.5	-0.5	-0.4	-0.3	-0.2	-0.2
70%	-0.4	-0.6	-0.6	-0.5	-0.4	-0.4	-0.6	-0.5	-0.4	-0.3	-0.3	-0.2
80%	-0.5	-0.6	-0.7	-0.6	-0.4	-0.5	-0.6	-0.6	-0.5	-0.4	-0.3	-0.3
90%	-0.5	-0.7	-0.7	-0.6	-0.6	-0.6	-0.7	-0.6	-0.5	-0.4	-0.3	-0.3
Long Term												
Full Simulation Period ^b	-0.3	-0.5	-0.4	-0.2	0.0	-0.1	-0.4	-0.4	-0.3	-0.3	-0.2	-0.2
Water Year Types ^c												
Wet (32%)	-0.3	-0.4	-0.1	0.3	0.5	0.3	-0.1	-0.2	-0.2	-0.2	-0.2	-0.1
Above Normal (16%)	-0.3	-0.4	-0.4	-0.1	0.2	-0.1	-0.3	-0.4	-0.4	-0.3	-0.2	-0.2
Below Normal (13%)	-0.4	-0.5	-0.5	-0.4	-0.2	-0.5	-0.5	-0.5	-0.4	-0.3	-0.2	-0.1
Dry (24%)	-0.4	-0.6	-0.6	-0.5	-0.4	-0.3	-0.5	-0.5	-0.4	-0.3	-0.2	-0.2
Critical (15%)	-0.3	-0.5	-0.5	-0.5	-0.4	-0.5	-0.5	-0.6	-0.4	-0.3	-0.2	-0.2

Alternative 1 minus No Action Alternative												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0
30%	0.0	0.0	0.0	-0.1	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	-0.1	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	-0.1	0.0	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	-0.1	0.0	0.0	-0.1	-0.1	0.0	0.0	0.0	-0.1
Below Normal (13%)	0.0	0.0	0.0	-0.1	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-42-2.2. Mokelumne River at Terminous, Monthly Averaged Daily Minimum Elevation

No Action Alternative

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.1	-0.3	0.2	0.5	0.9	0.5	0.2	0.0	-0.1	-0.1	-0.1	0.0
20%	-0.2	-0.3	-0.1	0.3	0.4	0.1	0.0	-0.2	-0.2	-0.2	-0.1	0.0
30%	-0.2	-0.4	-0.3	-0.1	0.2	-0.1	-0.2	-0.3	-0.3	-0.2	-0.2	-0.1
40%	-0.3	-0.4	-0.4	-0.3	0.1	-0.2	-0.3	-0.4	-0.3	-0.3	-0.2	-0.1
50%	-0.3	-0.5	-0.4	-0.3	-0.1	-0.2	-0.4	-0.4	-0.4	-0.3	-0.2	-0.1
60%	-0.4	-0.5	-0.5	-0.4	-0.2	-0.3	-0.5	-0.5	-0.4	-0.3	-0.3	-0.2
70%	-0.4	-0.5	-0.6	-0.5	-0.3	-0.4	-0.5	-0.5	-0.4	-0.3	-0.3	-0.2
80%	-0.4	-0.6	-0.6	-0.5	-0.4	-0.5	-0.6	-0.5	-0.5	-0.4	-0.3	-0.3
90%	-0.5	-0.6	-0.7	-0.6	-0.5	-0.6	-0.6	-0.6	-0.5	-0.4	-0.3	-0.3
Long Term												
Full Simulation Period ^b	-0.3	-0.4	-0.4	-0.1	0.1	-0.1	-0.3	-0.4	-0.3	-0.3	-0.2	-0.1
Water Year Types ^c												
Wet (32%)	-0.3	-0.4	-0.1	0.3	0.5	0.3	0.0	-0.2	-0.2	-0.2	-0.2	0.0
Above Normal (16%)	-0.3	-0.4	-0.4	-0.1	0.3	-0.1	-0.3	-0.3	-0.4	-0.3	-0.2	-0.2
Below Normal (13%)	-0.3	-0.5	-0.5	-0.4	-0.2	-0.4	-0.4	-0.5	-0.4	-0.3	-0.2	-0.1
Dry (24%)	-0.3	-0.5	-0.6	-0.5	-0.3	-0.3	-0.5	-0.5	-0.4	-0.3	-0.2	-0.2
Critical (15%)	-0.3	-0.5	-0.5	-0.5	-0.3	-0.5	-0.5	-0.6	-0.4	-0.3	-0.2	-0.2

Alternative 3

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.1	-0.3	0.1	0.5	0.9	0.5	0.1	0.0	-0.1	-0.1	-0.1	0.0
20%	-0.2	-0.4	-0.1	0.3	0.4	0.1	0.0	-0.3	-0.3	-0.2	-0.1	-0.1
30%	-0.3	-0.4	-0.3	-0.1	0.2	-0.1	-0.3	-0.3	-0.3	-0.2	-0.2	-0.1
40%	-0.3	-0.4	-0.4	-0.2	0.1	-0.2	-0.4	-0.4	-0.3	-0.2	-0.2	-0.1
50%	-0.4	-0.5	-0.4	-0.3	-0.1	-0.3	-0.5	-0.5	-0.4	-0.3	-0.2	-0.2
60%	-0.4	-0.5	-0.5	-0.4	-0.3	-0.3	-0.5	-0.5	-0.4	-0.3	-0.2	-0.2
70%	-0.4	-0.6	-0.5	-0.4	-0.3	-0.4	-0.6	-0.6	-0.4	-0.3	-0.3	-0.2
80%	-0.4	-0.6	-0.6	-0.5	-0.4	-0.5	-0.6	-0.6	-0.5	-0.4	-0.3	-0.3
90%	-0.5	-0.7	-0.7	-0.6	-0.5	-0.6	-0.7	-0.6	-0.5	-0.4	-0.3	-0.3
Long Term												
Full Simulation Period ^b	-0.3	-0.5	-0.4	-0.1	0.1	-0.1	-0.4	-0.4	-0.3	-0.3	-0.2	-0.2
Water Year Types ^c												
Wet (32%)	-0.3	-0.4	-0.1	0.3	0.5	0.3	-0.1	-0.2	-0.2	-0.2	-0.2	-0.1
Above Normal (16%)	-0.3	-0.4	-0.4	0.0	0.3	-0.1	-0.3	-0.4	-0.4	-0.3	-0.2	-0.2
Below Normal (13%)	-0.4	-0.5	-0.4	-0.4	-0.1	-0.4	-0.5	-0.5	-0.4	-0.3	-0.2	-0.1
Dry (24%)	-0.4	-0.6	-0.6	-0.4	-0.3	-0.3	-0.5	-0.5	-0.4	-0.3	-0.2	-0.2
Critical (15%)	-0.3	-0.5	-0.5	-0.5	-0.3	-0.5	-0.5	-0.6	-0.4	-0.3	-0.2	-0.2

Alternative 3 minus No Action Alternative

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0
30%	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.0	0.0	0.0	-0.1
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-42-2.3. Mokelumne River at Terminous, Monthly Averaged Daily Minimum Elevation

No Action Alternative												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-0.1	-0.3	0.2	0.5	0.9	0.5	0.2	0.0	-0.1	-0.1	-0.1	0.0
20%	-0.2	-0.3	-0.1	0.3	0.4	0.1	0.0	-0.2	-0.2	-0.2	-0.1	0.0
30%	-0.2	-0.4	-0.3	-0.1	0.2	-0.1	-0.2	-0.3	-0.3	-0.2	-0.2	-0.1
40%	-0.3	-0.4	-0.4	-0.3	0.1	-0.2	-0.3	-0.4	-0.3	-0.3	-0.2	-0.1
50%	-0.3	-0.5	-0.4	-0.3	-0.1	-0.2	-0.4	-0.4	-0.4	-0.3	-0.2	-0.1
60%	-0.4	-0.5	-0.5	-0.4	-0.2	-0.3	-0.5	-0.5	-0.4	-0.3	-0.3	-0.2
70%	-0.4	-0.5	-0.6	-0.5	-0.3	-0.4	-0.5	-0.5	-0.4	-0.3	-0.3	-0.2
80%	-0.4	-0.6	-0.6	-0.5	-0.4	-0.5	-0.6	-0.5	-0.5	-0.4	-0.3	-0.3
90%	-0.5	-0.6	-0.7	-0.6	-0.5	-0.6	-0.6	-0.6	-0.5	-0.4	-0.3	-0.3
Long Term												
Full Simulation Period ^b	-0.3	-0.4	-0.4	-0.1	0.1	-0.1	-0.3	-0.4	-0.3	-0.3	-0.2	-0.1
Water Year Types^c												
Wet (32%)	-0.3	-0.4	-0.1	0.3	0.5	0.3	0.0	-0.2	-0.2	-0.2	-0.2	0.0
Above Normal (16%)	-0.3	-0.4	-0.4	-0.1	0.3	-0.1	-0.3	-0.3	-0.4	-0.3	-0.2	-0.2
Below Normal (13%)	-0.3	-0.5	-0.5	-0.4	-0.2	-0.4	-0.4	-0.5	-0.4	-0.3	-0.2	-0.1
Dry (24%)	-0.3	-0.5	-0.6	-0.5	-0.3	-0.3	-0.5	-0.5	-0.4	-0.3	-0.2	-0.2
Critical (15%)	-0.3	-0.5	-0.5	-0.5	-0.3	-0.5	-0.5	-0.6	-0.4	-0.3	-0.2	-0.2

Alternative 5												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-0.1	-0.3	0.2	0.5	0.9	0.5	0.2	0.0	-0.1	-0.1	-0.1	0.0
20%	-0.2	-0.3	-0.1	0.3	0.4	0.1	0.0	-0.2	-0.2	-0.2	-0.1	0.0
30%	-0.2	-0.4	-0.3	-0.1	0.2	-0.1	-0.2	-0.3	-0.3	-0.2	-0.2	-0.1
40%	-0.3	-0.4	-0.4	-0.3	0.1	-0.2	-0.3	-0.4	-0.3	-0.3	-0.2	-0.1
50%	-0.3	-0.4	-0.4	-0.3	-0.1	-0.2	-0.4	-0.4	-0.4	-0.3	-0.2	-0.1
60%	-0.4	-0.5	-0.5	-0.4	-0.2	-0.3	-0.5	-0.5	-0.4	-0.3	-0.3	-0.2
70%	-0.4	-0.5	-0.6	-0.5	-0.3	-0.4	-0.5	-0.5	-0.4	-0.3	-0.3	-0.2
80%	-0.4	-0.6	-0.6	-0.5	-0.4	-0.5	-0.6	-0.5	-0.5	-0.4	-0.3	-0.3
90%	-0.5	-0.6	-0.7	-0.6	-0.5	-0.6	-0.6	-0.6	-0.5	-0.4	-0.3	-0.3
Long Term												
Full Simulation Period ^b	-0.3	-0.4	-0.4	-0.1	0.1	-0.1	-0.3	-0.4	-0.3	-0.3	-0.2	-0.1
Water Year Types^c												
Wet (32%)	-0.3	-0.4	-0.1	0.3	0.5	0.3	0.0	-0.2	-0.2	-0.2	-0.2	0.0
Above Normal (16%)	-0.3	-0.4	-0.4	-0.1	0.3	-0.1	-0.3	-0.3	-0.4	-0.3	-0.2	-0.2
Below Normal (13%)	-0.3	-0.5	-0.5	-0.4	-0.2	-0.4	-0.4	-0.5	-0.4	-0.3	-0.2	-0.1
Dry (24%)	-0.3	-0.5	-0.6	-0.5	-0.3	-0.3	-0.5	-0.5	-0.4	-0.3	-0.2	-0.2
Critical (15%)	-0.3	-0.5	-0.5	-0.5	-0.3	-0.5	-0.5	-0.5	-0.4	-0.3	-0.2	-0.2

Alternative 5 minus No Action Alternative												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
30%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-42-2-4. Mokelumne River at Terminous, Monthly Averaged Daily Minimum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.1	-0.3	0.1	0.5	0.9	0.6	0.1	0.0	-0.1	-0.1	0.0	0.0
20%	-0.2	-0.4	-0.1	0.2	0.4	0.1	0.0	-0.2	-0.2	-0.2	-0.1	-0.1
30%	-0.3	-0.4	-0.3	-0.2	0.2	-0.1	-0.3	-0.3	-0.3	-0.2	-0.1	-0.1
40%	-0.3	-0.4	-0.4	-0.3	0.1	-0.2	-0.4	-0.4	-0.3	-0.2	-0.2	-0.1
50%	-0.4	-0.5	-0.5	-0.4	-0.2	-0.3	-0.5	-0.5	-0.4	-0.3	-0.2	-0.2
60%	-0.4	-0.5	-0.5	-0.5	-0.3	-0.4	-0.5	-0.5	-0.4	-0.3	-0.2	-0.2
70%	-0.4	-0.6	-0.6	-0.5	-0.4	-0.4	-0.6	-0.5	-0.4	-0.3	-0.3	-0.2
80%	-0.5	-0.6	-0.7	-0.6	-0.4	-0.5	-0.6	-0.6	-0.5	-0.4	-0.3	-0.3
90%	-0.5	-0.7	-0.7	-0.6	-0.6	-0.6	-0.7	-0.6	-0.5	-0.4	-0.3	-0.3
Long Term												
Full Simulation Period ^b	-0.3	-0.5	-0.4	-0.2	0.0	-0.1	-0.4	-0.4	-0.3	-0.3	-0.2	-0.2
Water Year Types ^c												
Wet (32%)	-0.3	-0.4	-0.1	0.3	0.5	0.3	-0.1	-0.2	-0.2	-0.2	-0.2	-0.1
Above Normal (16%)	-0.3	-0.4	-0.4	-0.1	0.2	-0.1	-0.3	-0.4	-0.4	-0.3	-0.2	-0.2
Below Normal (13%)	-0.4	-0.5	-0.5	-0.4	-0.2	-0.5	-0.5	-0.5	-0.4	-0.3	-0.2	-0.1
Dry (24%)	-0.4	-0.6	-0.6	-0.5	-0.4	-0.3	-0.5	-0.5	-0.4	-0.3	-0.2	-0.2
Critical (15%)	-0.3	-0.5	-0.5	-0.5	-0.4	-0.5	-0.5	-0.6	-0.4	-0.3	-0.2	-0.2

No Action Alternative

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.1	-0.3	0.2	0.5	0.9	0.5	0.2	0.0	-0.1	-0.1	-0.1	0.0
20%	-0.2	-0.3	-0.1	0.3	0.4	0.1	0.0	-0.2	-0.2	-0.2	-0.1	0.0
30%	-0.2	-0.4	-0.3	-0.1	0.2	-0.1	-0.2	-0.3	-0.3	-0.2	-0.2	-0.1
40%	-0.3	-0.4	-0.4	-0.3	0.1	-0.2	-0.3	-0.4	-0.3	-0.3	-0.2	-0.1
50%	-0.3	-0.5	-0.4	-0.3	-0.1	-0.2	-0.4	-0.4	-0.4	-0.3	-0.2	-0.1
60%	-0.4	-0.5	-0.5	-0.4	-0.2	-0.3	-0.5	-0.5	-0.4	-0.3	-0.3	-0.2
70%	-0.4	-0.5	-0.6	-0.5	-0.3	-0.4	-0.5	-0.5	-0.4	-0.3	-0.3	-0.2
80%	-0.4	-0.6	-0.6	-0.5	-0.4	-0.5	-0.6	-0.5	-0.5	-0.4	-0.3	-0.3
90%	-0.5	-0.6	-0.7	-0.6	-0.5	-0.6	-0.6	-0.6	-0.5	-0.4	-0.3	-0.3
Long Term												
Full Simulation Period ^b	-0.3	-0.4	-0.4	-0.1	0.1	-0.1	-0.3	-0.4	-0.3	-0.3	-0.2	-0.1
Water Year Types ^c												
Wet (32%)	-0.3	-0.4	-0.1	0.3	0.5	0.3	0.0	-0.2	-0.2	-0.2	-0.2	0.0
Above Normal (16%)	-0.3	-0.4	-0.4	-0.1	0.3	-0.1	-0.3	-0.3	-0.4	-0.3	-0.2	-0.2
Below Normal (13%)	-0.3	-0.5	-0.5	-0.4	-0.2	-0.4	-0.4	-0.5	-0.4	-0.3	-0.2	-0.1
Dry (24%)	-0.3	-0.5	-0.6	-0.5	-0.3	-0.3	-0.5	-0.5	-0.4	-0.3	-0.2	-0.2
Critical (15%)	-0.3	-0.5	-0.5	-0.5	-0.3	-0.5	-0.5	-0.6	-0.4	-0.3	-0.2	-0.2

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0
30%	0.0	0.0	0.0	0.1	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.1	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.1	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.1	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.1
Below Normal (13%)	0.0	0.0	0.0	0.1	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-42-2-5. Mokelumne River at Terminous, Monthly Averaged Daily Minimum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.1	-0.3	0.1	0.5	0.9	0.6	0.1	0.0	-0.1	-0.1	0.0	0.0
20%	-0.2	-0.4	-0.1	0.2	0.4	0.1	0.0	-0.2	-0.2	-0.2	-0.1	-0.1
30%	-0.3	-0.4	-0.3	-0.2	0.2	-0.1	-0.3	-0.3	-0.3	-0.2	-0.1	-0.1
40%	-0.3	-0.4	-0.4	-0.3	0.1	-0.2	-0.4	-0.4	-0.3	-0.2	-0.2	-0.1
50%	-0.4	-0.5	-0.5	-0.4	-0.2	-0.3	-0.5	-0.5	-0.4	-0.3	-0.2	-0.2
60%	-0.4	-0.5	-0.5	-0.5	-0.3	-0.4	-0.5	-0.5	-0.4	-0.3	-0.2	-0.2
70%	-0.4	-0.6	-0.6	-0.5	-0.4	-0.4	-0.6	-0.5	-0.4	-0.3	-0.3	-0.2
80%	-0.5	-0.6	-0.7	-0.6	-0.4	-0.5	-0.6	-0.6	-0.5	-0.4	-0.3	-0.3
90%	-0.5	-0.7	-0.7	-0.6	-0.6	-0.6	-0.7	-0.6	-0.5	-0.4	-0.3	-0.3
Long Term												
Full Simulation Period ^b	-0.3	-0.5	-0.4	-0.2	0.0	-0.1	-0.4	-0.4	-0.3	-0.3	-0.2	-0.2
Water Year Types ^c												
Wet (32%)	-0.3	-0.4	-0.1	0.3	0.5	0.3	-0.1	-0.2	-0.2	-0.2	-0.2	-0.1
Above Normal (16%)	-0.3	-0.4	-0.4	-0.1	0.2	-0.1	-0.3	-0.4	-0.4	-0.3	-0.2	-0.2
Below Normal (13%)	-0.4	-0.5	-0.5	-0.4	-0.2	-0.5	-0.5	-0.5	-0.4	-0.3	-0.2	-0.1
Dry (24%)	-0.4	-0.6	-0.6	-0.5	-0.4	-0.3	-0.5	-0.5	-0.4	-0.3	-0.2	-0.2
Critical (15%)	-0.3	-0.5	-0.5	-0.5	-0.4	-0.5	-0.5	-0.6	-0.4	-0.3	-0.2	-0.2

Alternative 3

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.1	-0.3	0.1	0.5	0.9	0.5	0.1	0.0	-0.1	-0.1	-0.1	0.0
20%	-0.2	-0.4	-0.1	0.3	0.4	0.1	0.0	-0.3	-0.3	-0.2	-0.1	-0.1
30%	-0.3	-0.4	-0.3	-0.1	0.2	-0.1	-0.3	-0.3	-0.3	-0.2	-0.2	-0.1
40%	-0.3	-0.4	-0.4	-0.2	0.1	-0.2	-0.4	-0.4	-0.3	-0.2	-0.2	-0.1
50%	-0.4	-0.5	-0.4	-0.3	-0.1	-0.3	-0.5	-0.5	-0.4	-0.3	-0.2	-0.2
60%	-0.4	-0.5	-0.5	-0.4	-0.3	-0.3	-0.5	-0.5	-0.4	-0.3	-0.2	-0.2
70%	-0.4	-0.6	-0.5	-0.4	-0.3	-0.4	-0.6	-0.6	-0.4	-0.3	-0.3	-0.2
80%	-0.4	-0.6	-0.6	-0.5	-0.4	-0.5	-0.6	-0.6	-0.5	-0.4	-0.3	-0.3
90%	-0.5	-0.7	-0.7	-0.6	-0.5	-0.6	-0.7	-0.6	-0.5	-0.4	-0.3	-0.3
Long Term												
Full Simulation Period ^b	-0.3	-0.5	-0.4	-0.1	0.1	-0.1	-0.4	-0.4	-0.3	-0.3	-0.2	-0.2
Water Year Types ^c												
Wet (32%)	-0.3	-0.4	-0.1	0.3	0.5	0.3	-0.1	-0.2	-0.2	-0.2	-0.2	-0.1
Above Normal (16%)	-0.3	-0.4	-0.4	0.0	0.3	-0.1	-0.3	-0.4	-0.4	-0.3	-0.2	-0.2
Below Normal (13%)	-0.4	-0.5	-0.4	-0.4	-0.1	-0.4	-0.5	-0.5	-0.4	-0.3	-0.2	-0.1
Dry (24%)	-0.4	-0.6	-0.6	-0.4	-0.3	-0.3	-0.5	-0.5	-0.4	-0.3	-0.2	-0.2
Critical (15%)	-0.3	-0.5	-0.5	-0.5	-0.3	-0.5	-0.5	-0.6	-0.4	-0.3	-0.2	-0.2

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
30%	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-42-2.6. Mokelumne River at Terminous, Monthly Averaged Daily Minimum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.1	-0.3	0.1	0.5	0.9	0.6	0.1	0.0	-0.1	-0.1	0.0	0.0
20%	-0.2	-0.4	-0.1	0.2	0.4	0.1	0.0	-0.2	-0.2	-0.2	-0.1	-0.1
30%	-0.3	-0.4	-0.3	-0.2	0.2	-0.1	-0.3	-0.3	-0.3	-0.2	-0.1	-0.1
40%	-0.3	-0.4	-0.4	-0.3	0.1	-0.2	-0.4	-0.4	-0.3	-0.2	-0.2	-0.1
50%	-0.4	-0.5	-0.5	-0.4	-0.2	-0.3	-0.5	-0.5	-0.4	-0.3	-0.2	-0.2
60%	-0.4	-0.5	-0.5	-0.5	-0.3	-0.4	-0.5	-0.5	-0.4	-0.3	-0.2	-0.2
70%	-0.4	-0.6	-0.6	-0.5	-0.4	-0.4	-0.6	-0.5	-0.4	-0.3	-0.3	-0.2
80%	-0.5	-0.6	-0.7	-0.6	-0.4	-0.5	-0.6	-0.6	-0.5	-0.4	-0.3	-0.3
90%	-0.5	-0.7	-0.7	-0.6	-0.6	-0.6	-0.7	-0.6	-0.5	-0.4	-0.3	-0.3
Long Term												
Full Simulation Period ^b	-0.3	-0.5	-0.4	-0.2	0.0	-0.1	-0.4	-0.4	-0.3	-0.3	-0.2	-0.2
Water Year Types ^c												
Wet (32%)	-0.3	-0.4	-0.1	0.3	0.5	0.3	-0.1	-0.2	-0.2	-0.2	-0.2	-0.1
Above Normal (16%)	-0.3	-0.4	-0.4	-0.1	0.2	-0.1	-0.3	-0.4	-0.4	-0.3	-0.2	-0.2
Below Normal (13%)	-0.4	-0.5	-0.5	-0.4	-0.2	-0.5	-0.5	-0.5	-0.4	-0.3	-0.2	-0.1
Dry (24%)	-0.4	-0.6	-0.6	-0.5	-0.4	-0.3	-0.5	-0.5	-0.4	-0.3	-0.2	-0.2
Critical (15%)	-0.3	-0.5	-0.5	-0.5	-0.4	-0.5	-0.5	-0.6	-0.4	-0.3	-0.2	-0.2

Alternative 5

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.1	-0.3	0.2	0.5	0.9	0.5	0.2	0.0	-0.1	-0.1	-0.1	0.0
20%	-0.2	-0.3	-0.1	0.3	0.4	0.1	0.0	-0.2	-0.2	-0.2	-0.1	0.0
30%	-0.2	-0.4	-0.3	-0.1	0.2	-0.1	-0.2	-0.3	-0.3	-0.2	-0.2	-0.1
40%	-0.3	-0.4	-0.4	-0.3	0.1	-0.2	-0.3	-0.4	-0.3	-0.3	-0.2	-0.1
50%	-0.3	-0.4	-0.4	-0.3	-0.1	-0.2	-0.4	-0.4	-0.4	-0.3	-0.2	-0.1
60%	-0.4	-0.5	-0.5	-0.4	-0.2	-0.3	-0.5	-0.5	-0.4	-0.3	-0.3	-0.2
70%	-0.4	-0.5	-0.6	-0.5	-0.3	-0.4	-0.5	-0.5	-0.4	-0.3	-0.3	-0.2
80%	-0.4	-0.6	-0.6	-0.5	-0.4	-0.5	-0.6	-0.5	-0.5	-0.4	-0.3	-0.3
90%	-0.5	-0.6	-0.7	-0.6	-0.5	-0.6	-0.6	-0.6	-0.5	-0.4	-0.3	-0.3
Long Term												
Full Simulation Period ^b	-0.3	-0.4	-0.4	-0.1	0.1	-0.1	-0.3	-0.4	-0.3	-0.3	-0.2	-0.1
Water Year Types ^c												
Wet (32%)	-0.3	-0.4	-0.1	0.3	0.5	0.3	0.0	-0.2	-0.2	-0.2	-0.2	0.0
Above Normal (16%)	-0.3	-0.4	-0.4	-0.1	0.3	-0.1	-0.3	-0.3	-0.4	-0.3	-0.2	-0.2
Below Normal (13%)	-0.3	-0.5	-0.5	-0.4	-0.2	-0.4	-0.4	-0.5	-0.4	-0.3	-0.2	-0.1
Dry (24%)	-0.3	-0.5	-0.6	-0.5	-0.3	-0.3	-0.5	-0.5	-0.4	-0.3	-0.2	-0.2
Critical (15%)	-0.3	-0.5	-0.5	-0.5	-0.3	-0.5	-0.5	-0.5	-0.4	-0.3	-0.2	-0.2

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0
30%	0.0	0.0	0.0	0.1	0.1	0.0	0.1	0.1	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.1	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.1	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.1	0.0	0.1	0.1	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.1	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.1
Below Normal (13%)	0.0	0.0	0.0	0.1	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.1	0.0	0.1	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 **C.43. Sacramento River at Freeport Water Surface Elevation**

Figure C-43-1-1. Sacramento River at Freeport, Monthly Averaged Daily Maximum Elevation, October

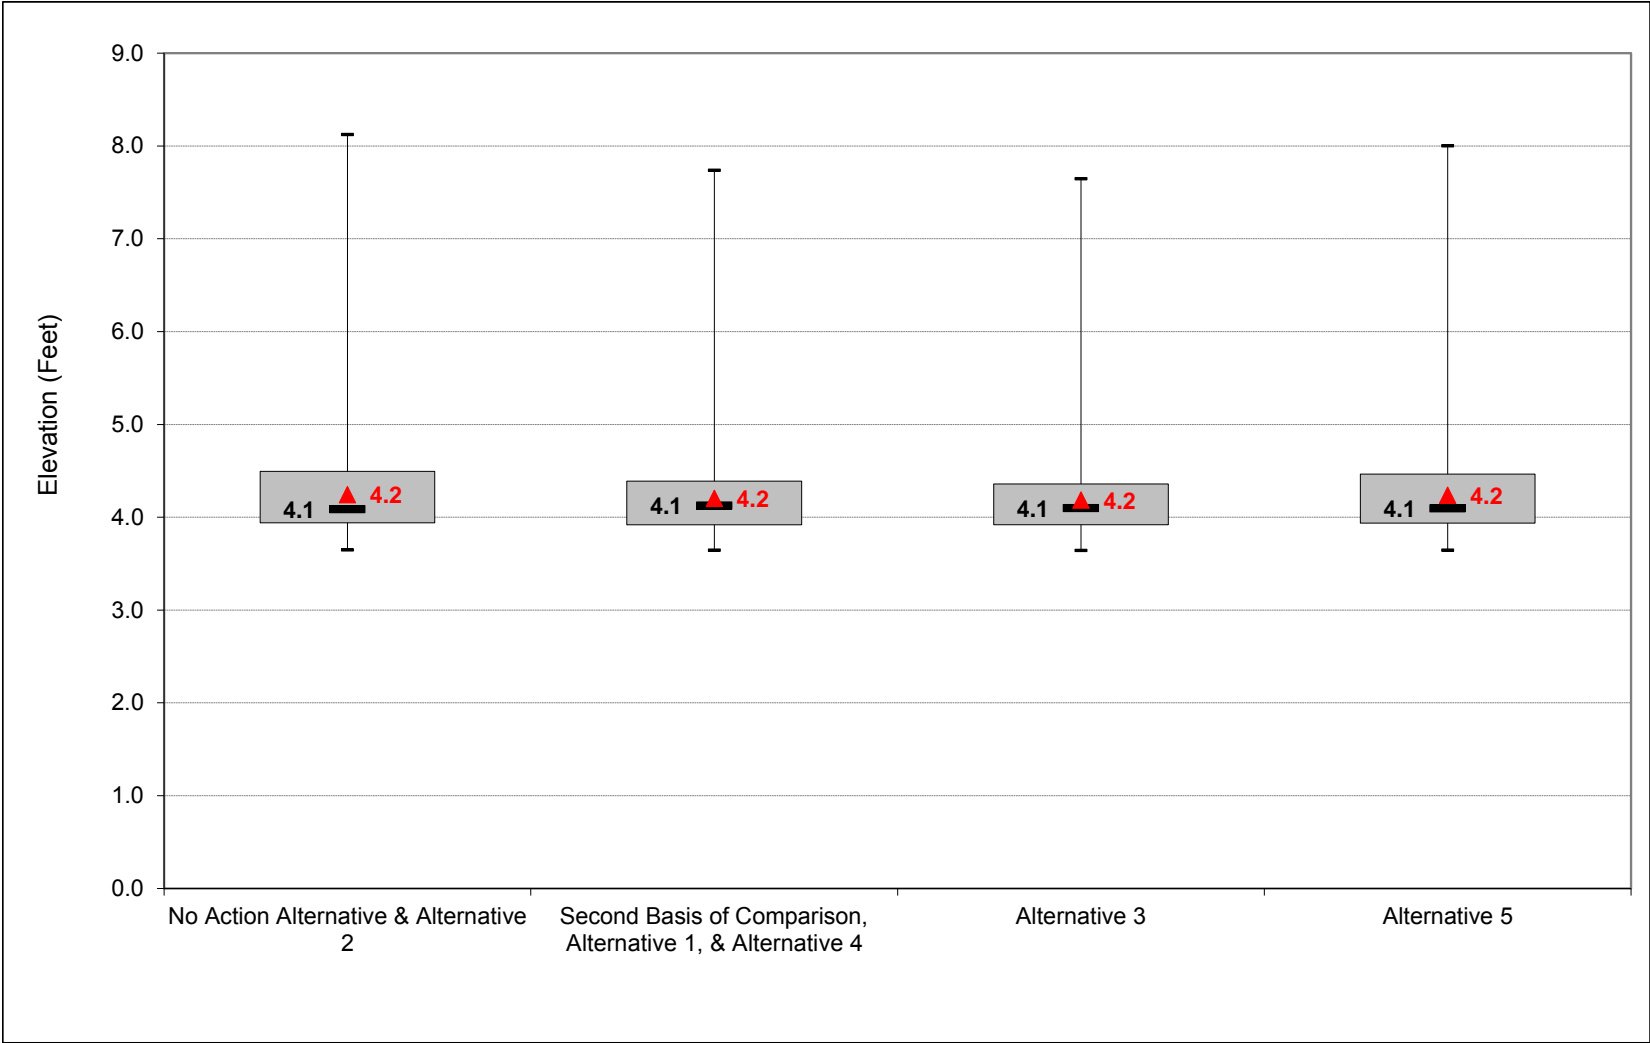


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-43-1-2. Sacramento River at Freeport, Monthly Averaged Daily Maximum Elevation, November

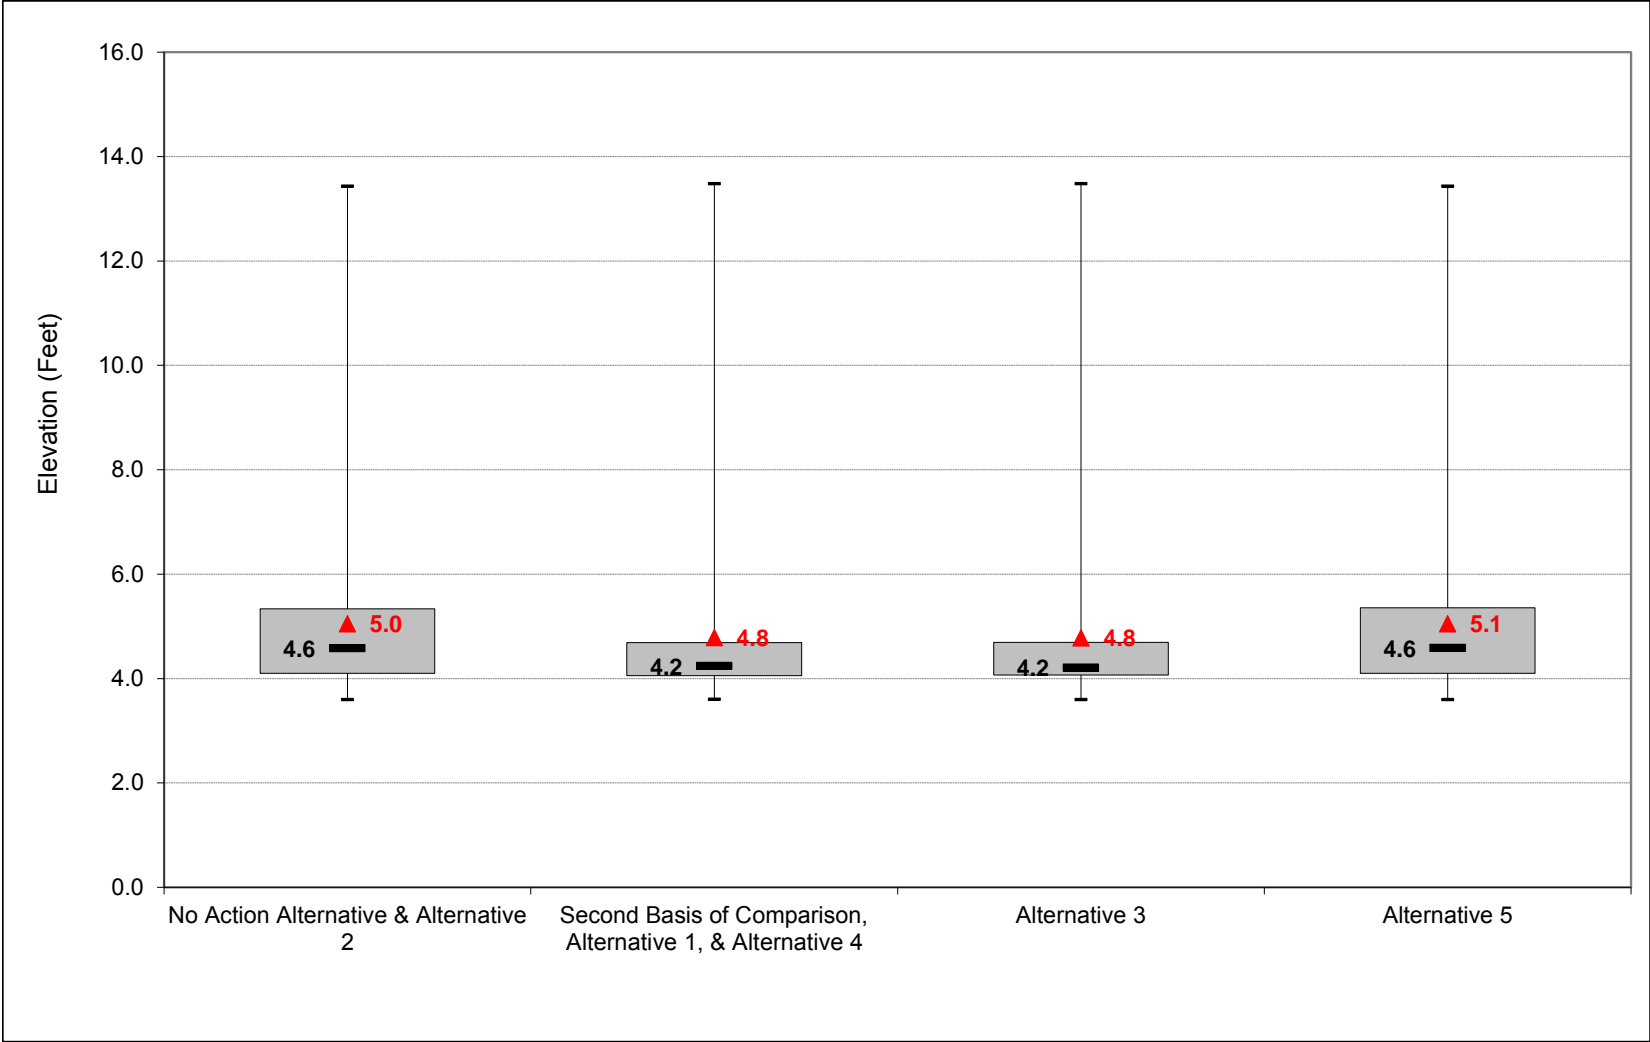


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-43-1-3. Sacramento River at Freeport, Monthly Averaged Daily Maximum Elevation, December

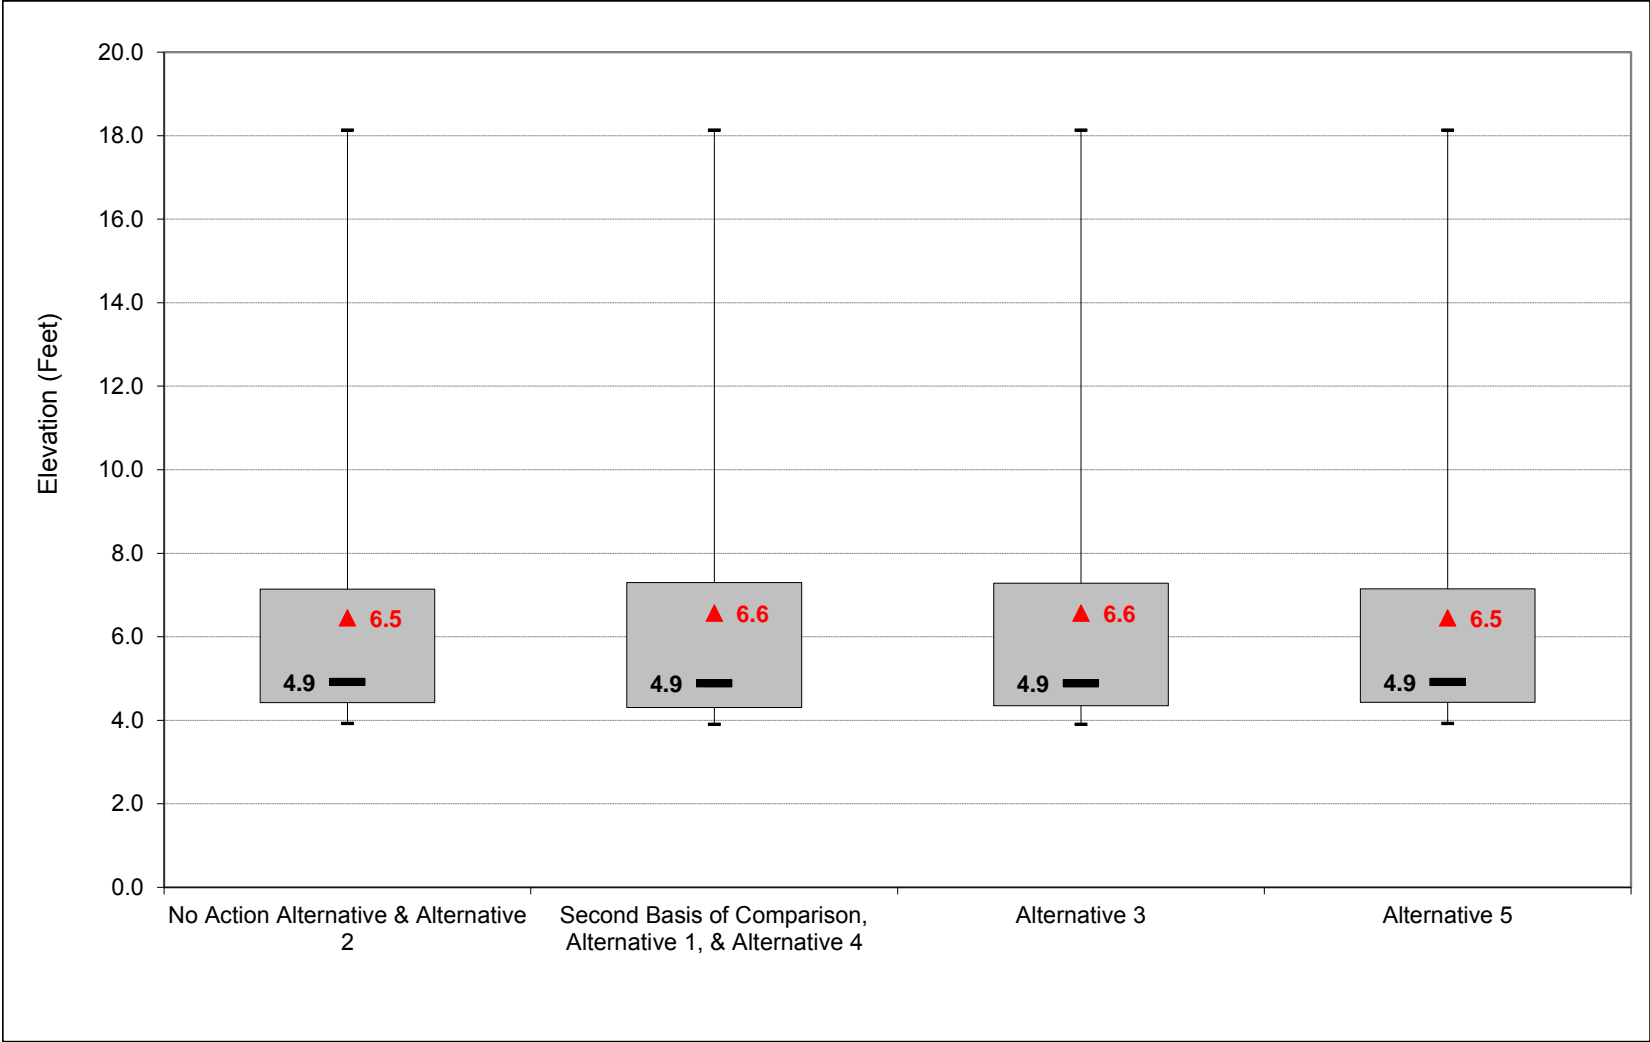


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-43-1-4. Sacramento River at Freeport, Monthly Averaged Daily Maximum Elevation, January

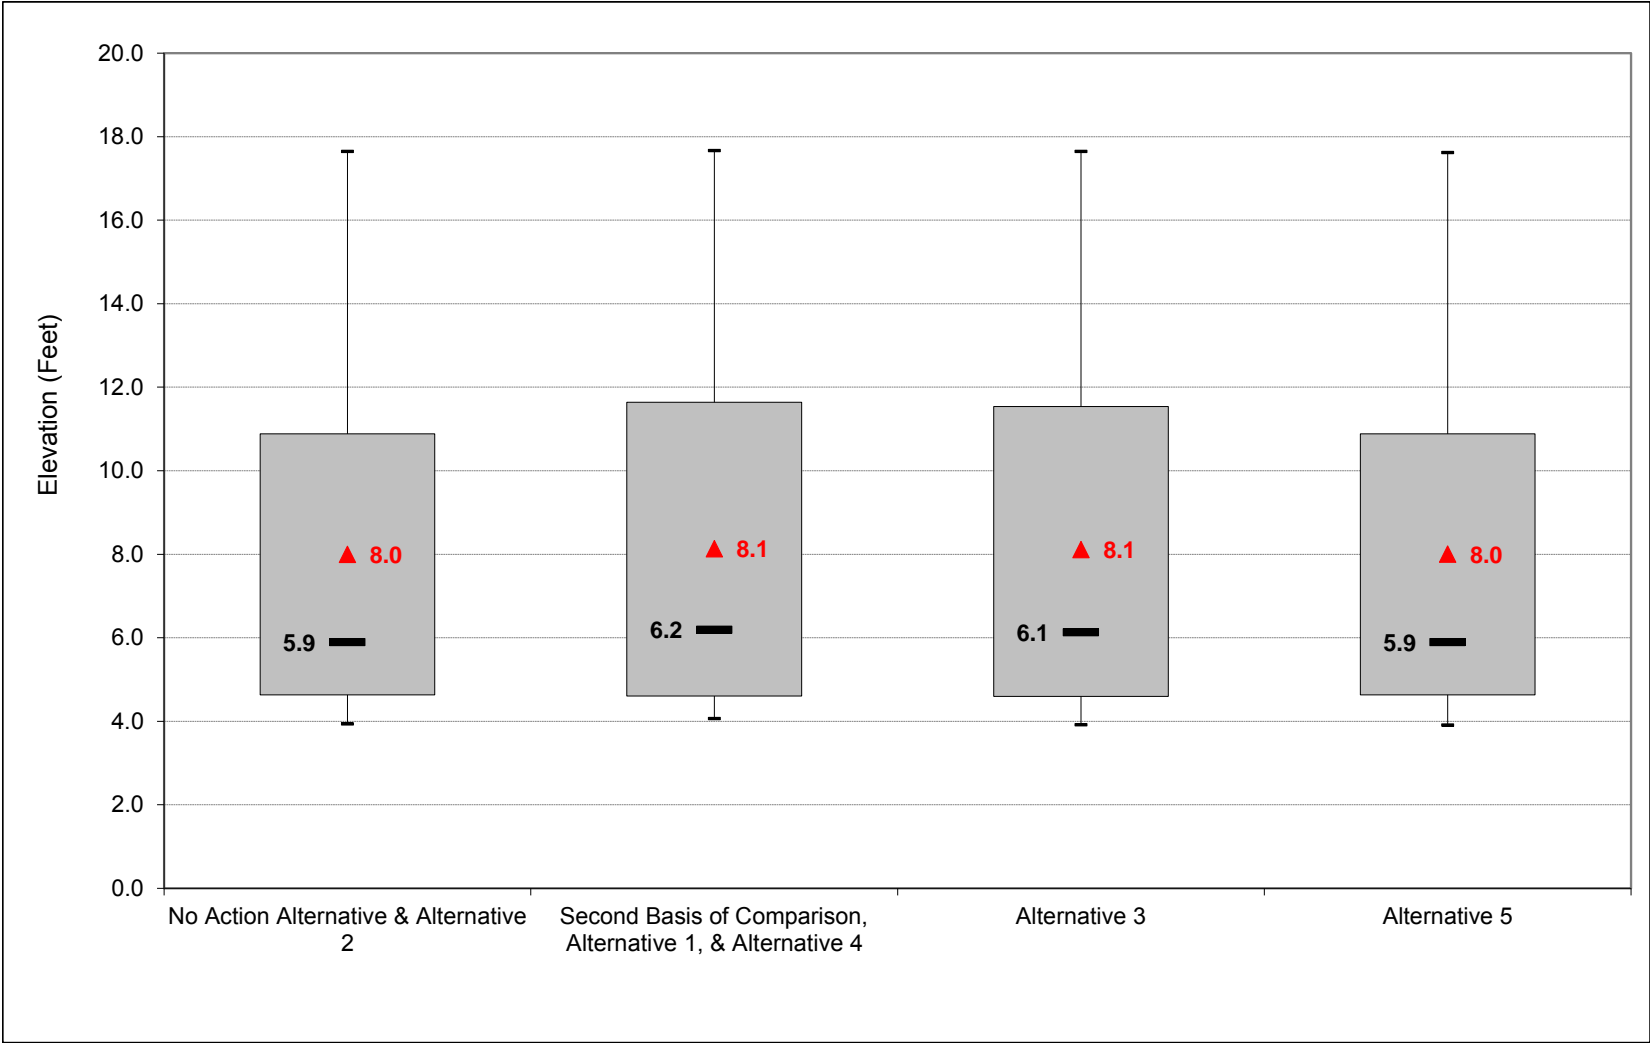


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-43-1-5. Sacramento River at Freeport, Monthly Averaged Daily Maximum Elevation, February

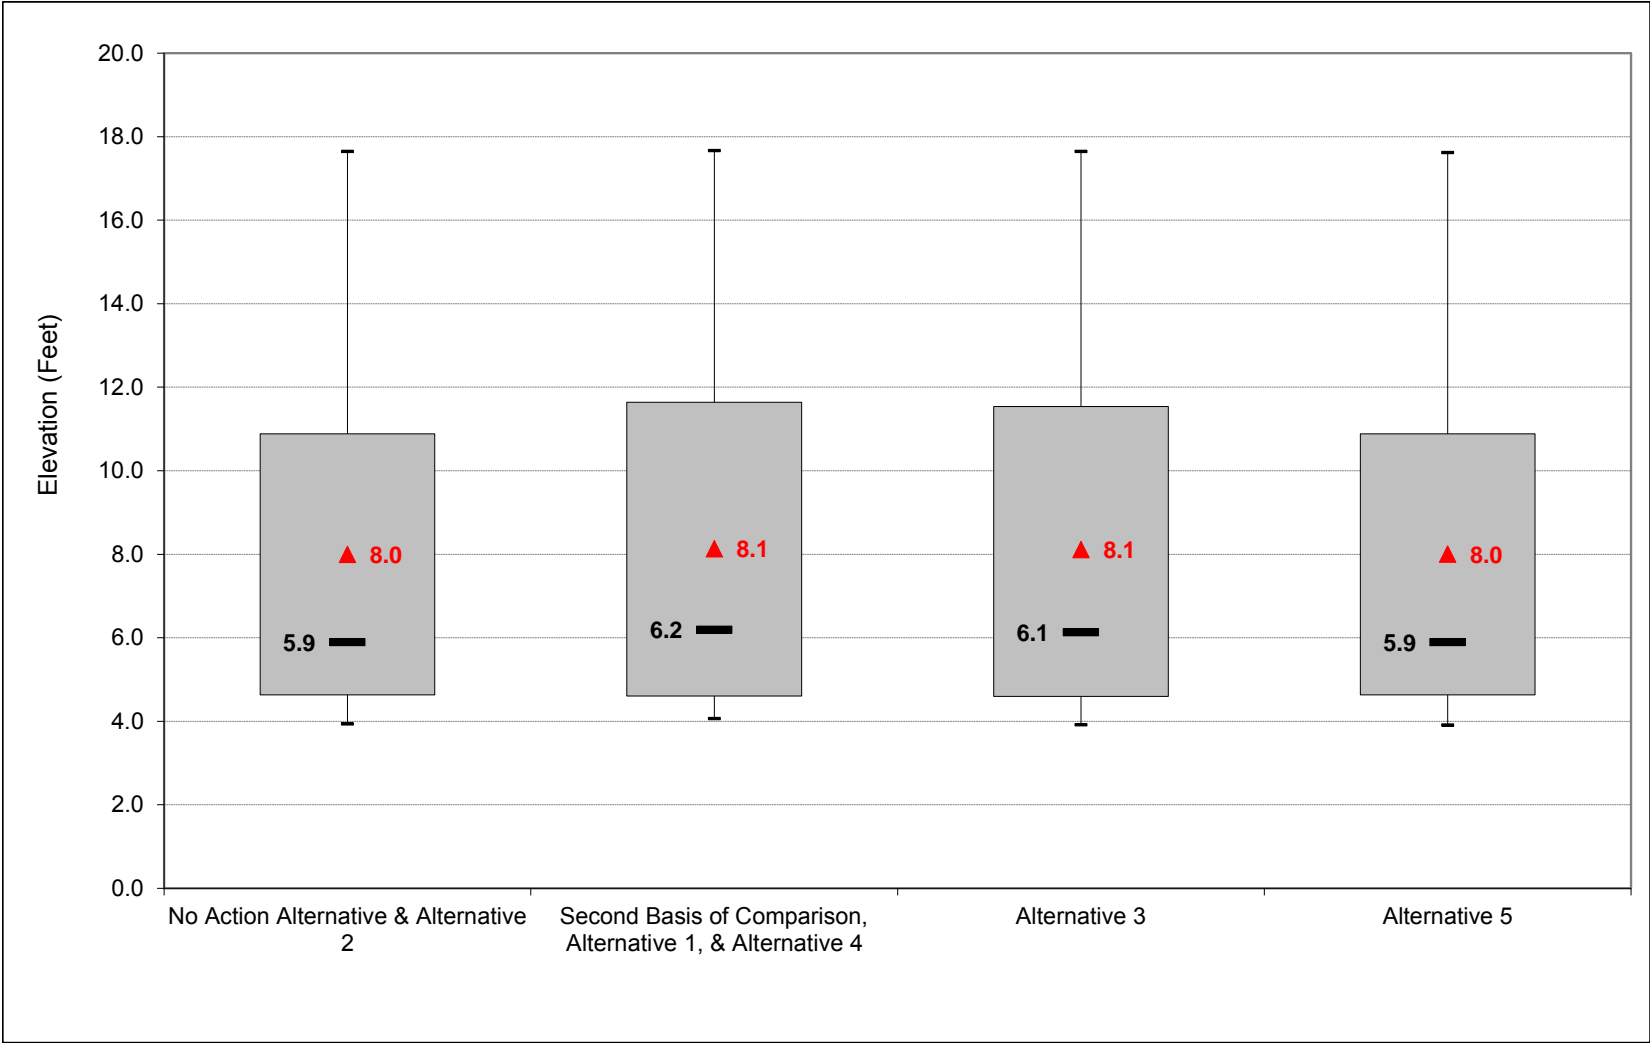


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-43-1-6. Sacramento River at Freeport, Monthly Averaged Daily Maximum Elevation, March

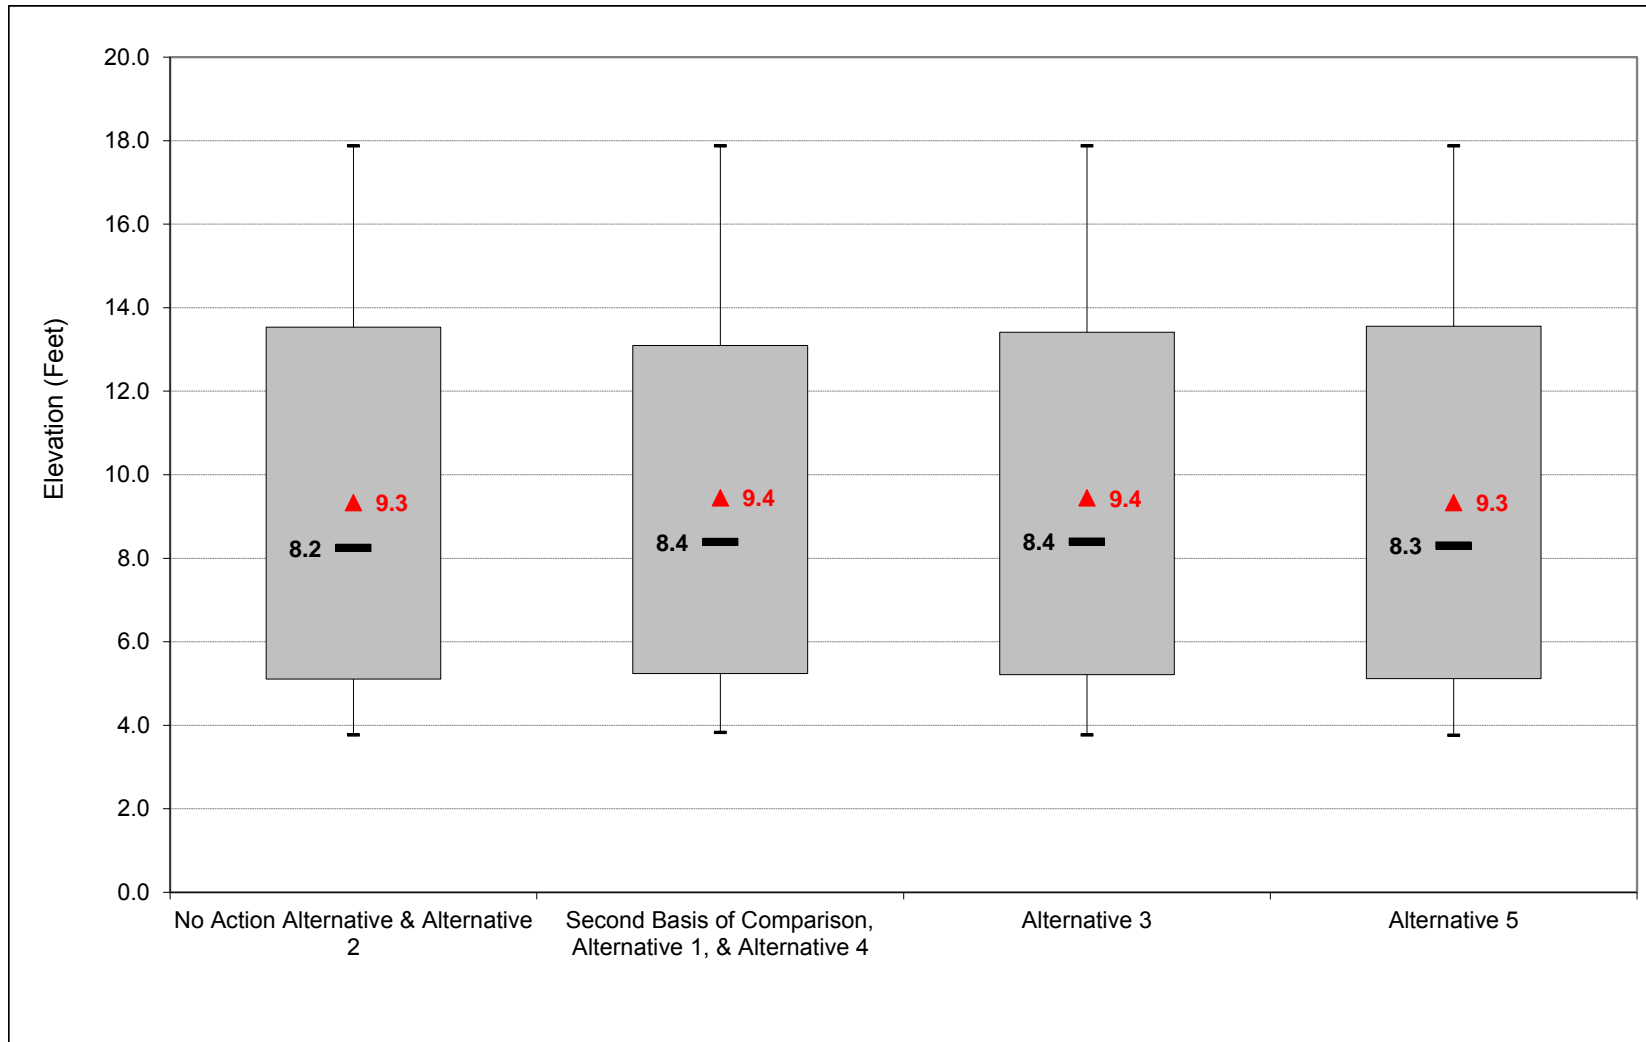


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-43-1-7. Sacramento River at Freeport, Monthly Averaged Daily Maximum Elevation, April

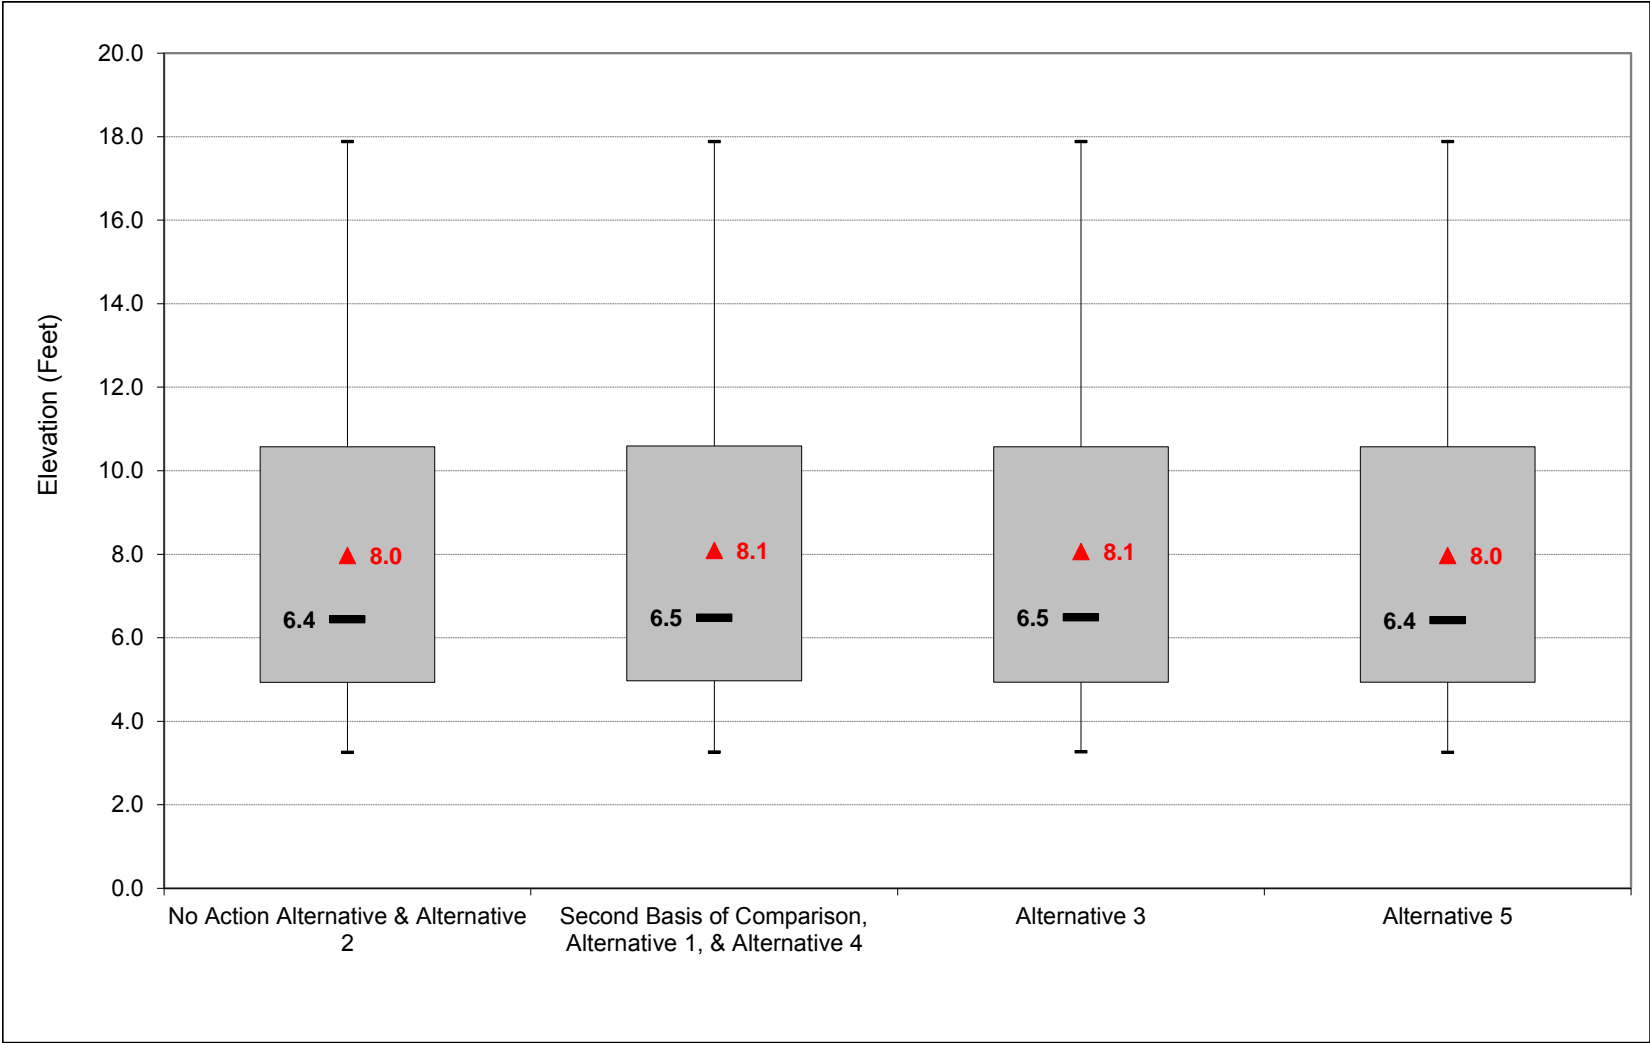


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-43-1-8. Sacramento River at Freeport, Monthly Averaged Daily Maximum Elevation, May

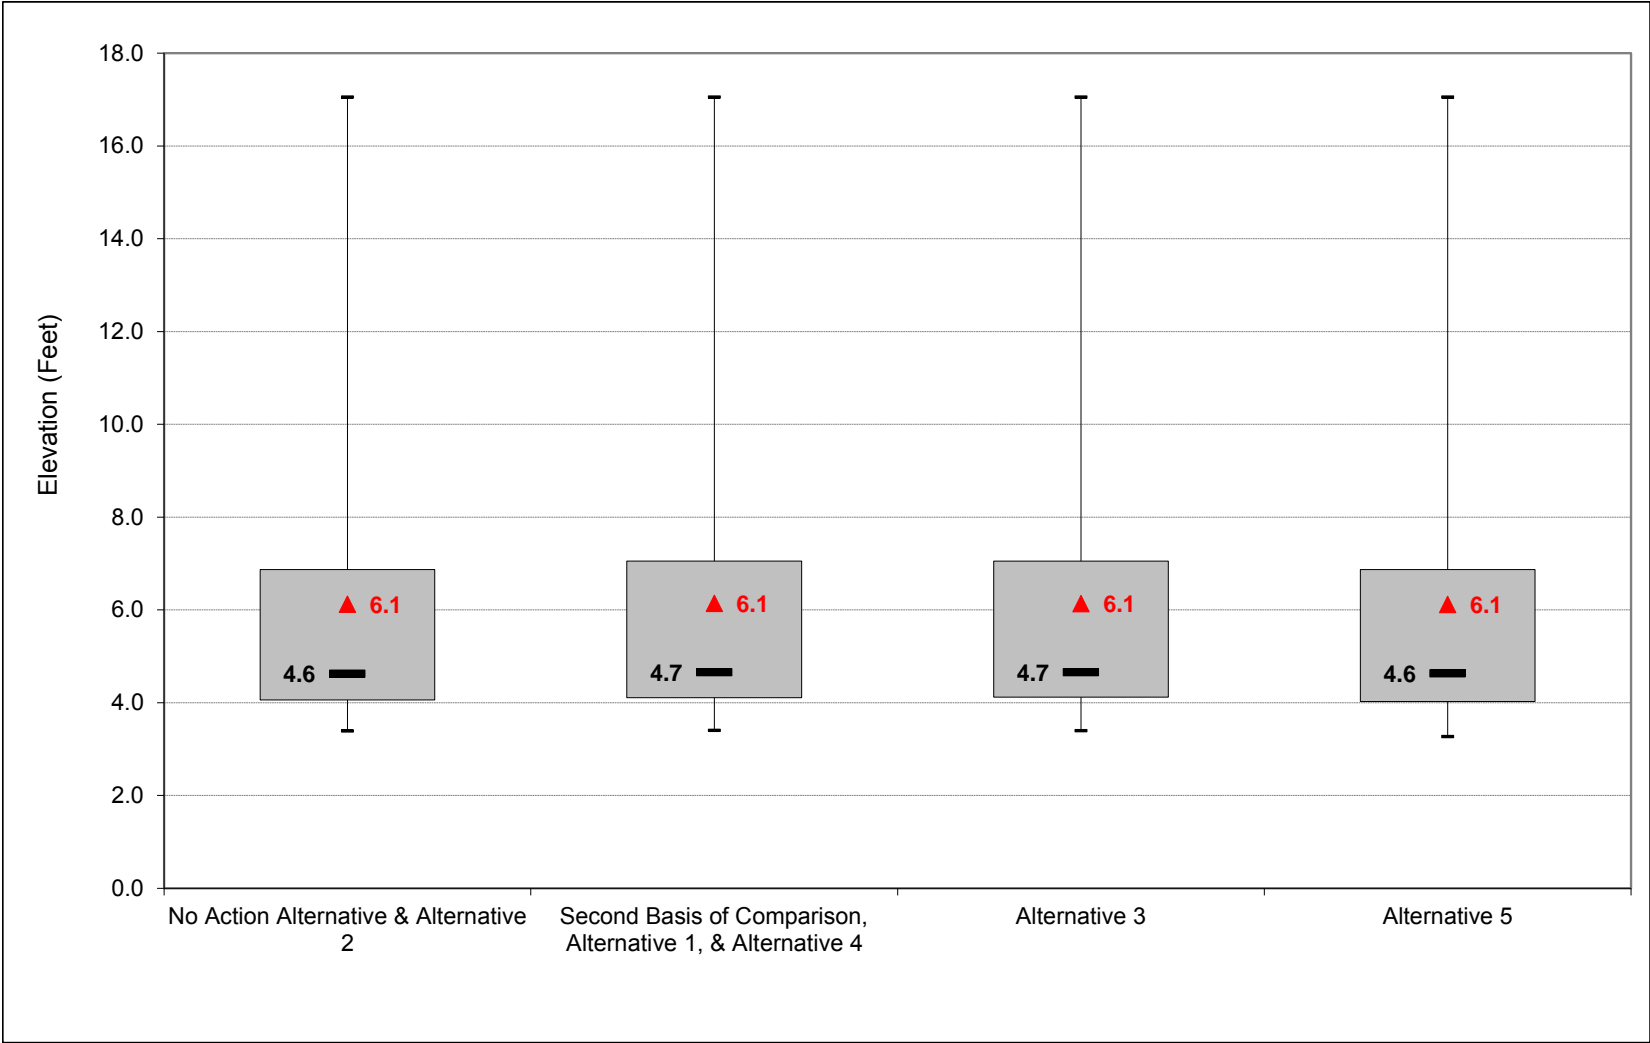


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-43-1-9. Sacramento River at Freeport, Monthly Averaged Daily Maximum Elevation, June

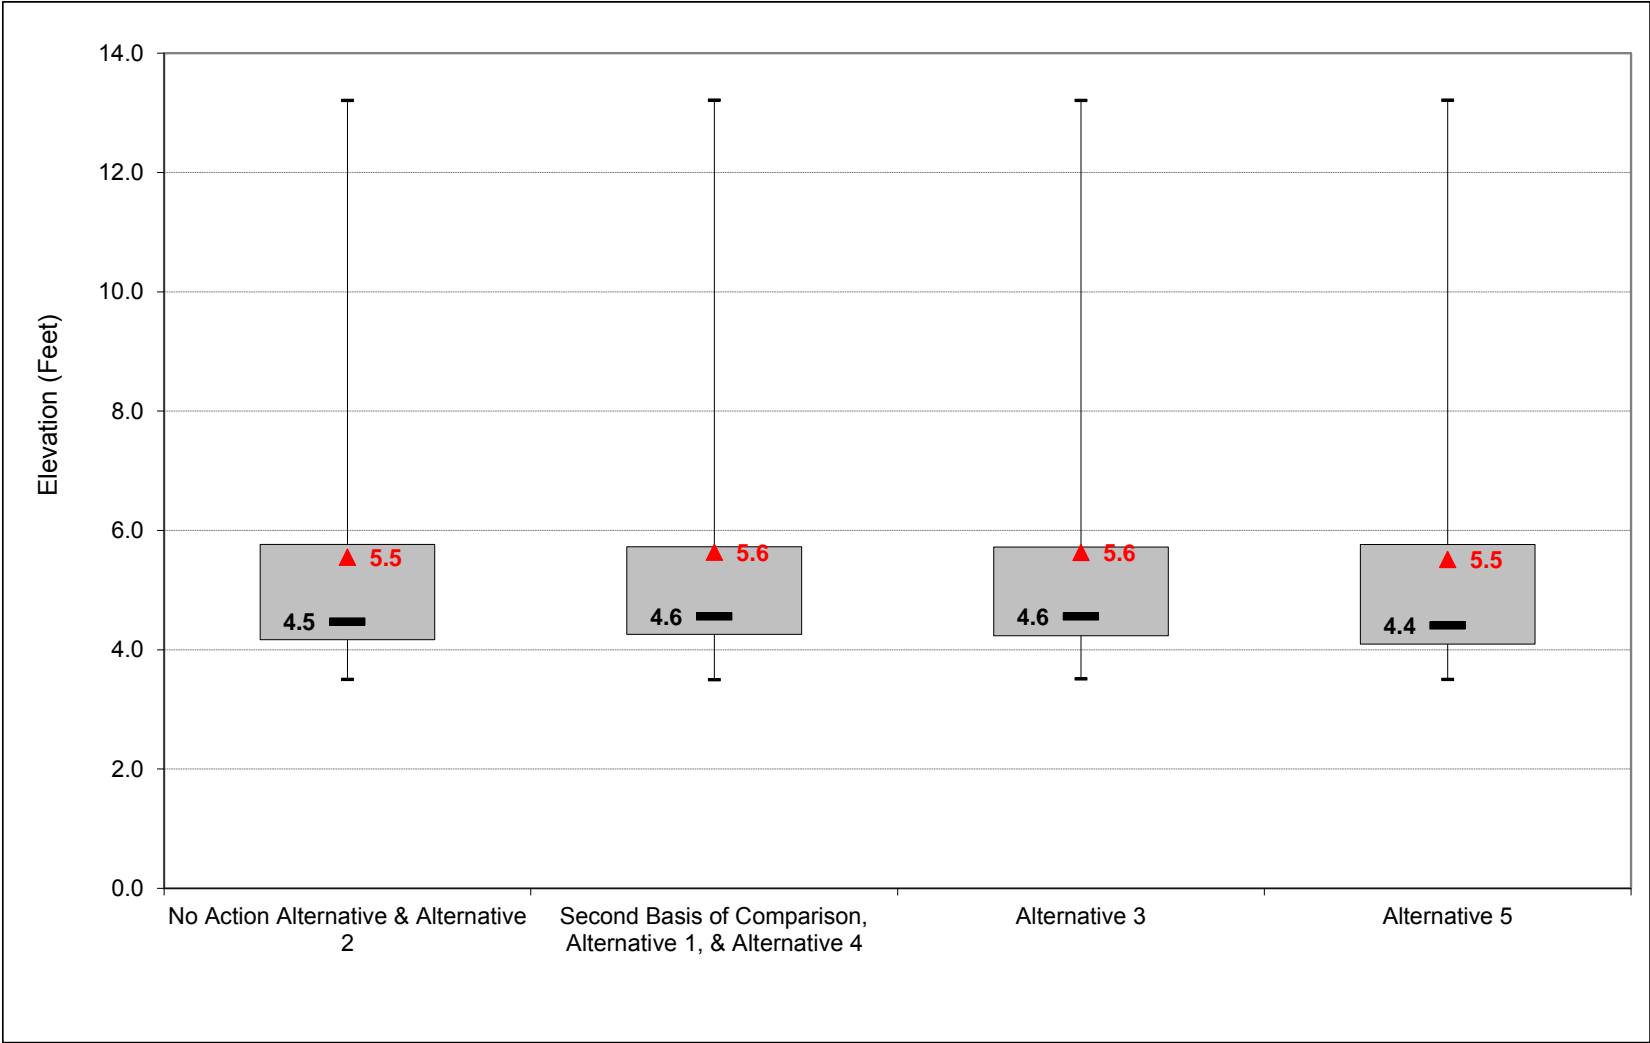


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-43-1-10. Sacramento River at Freeport, Monthly Averaged Daily Maximum Elevation, July

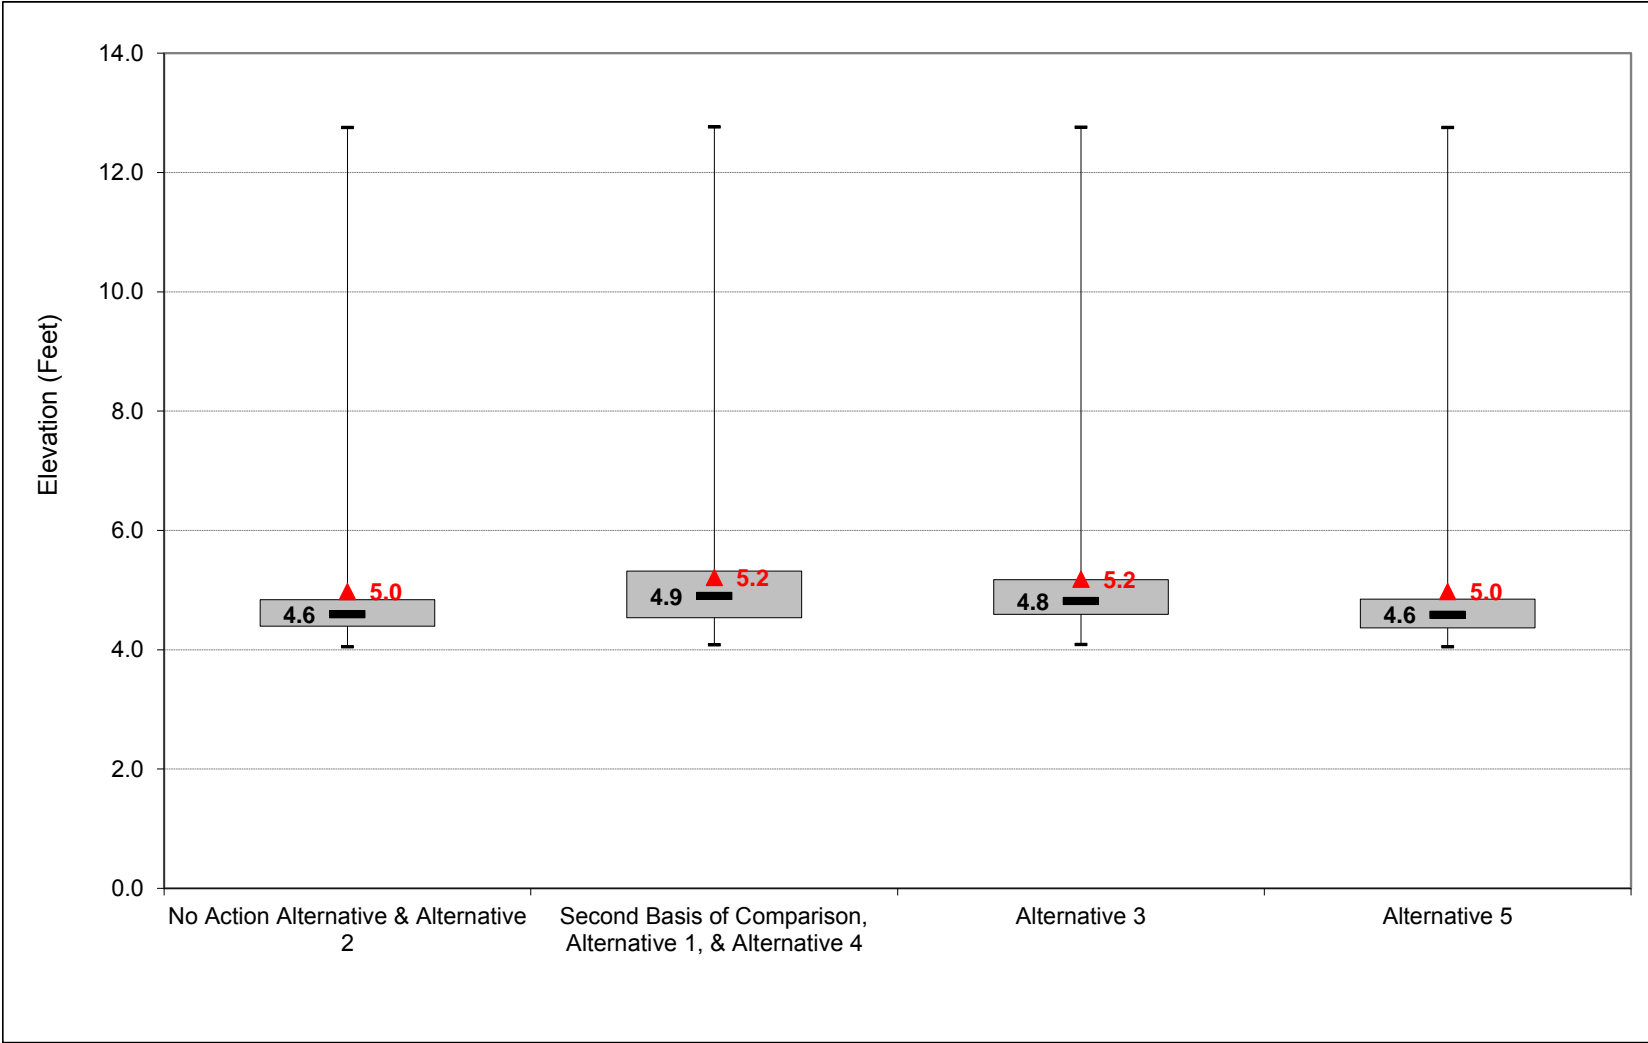


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-43-1-11. Sacramento River at Freeport, Monthly Averaged Daily Maximum Elevation, August

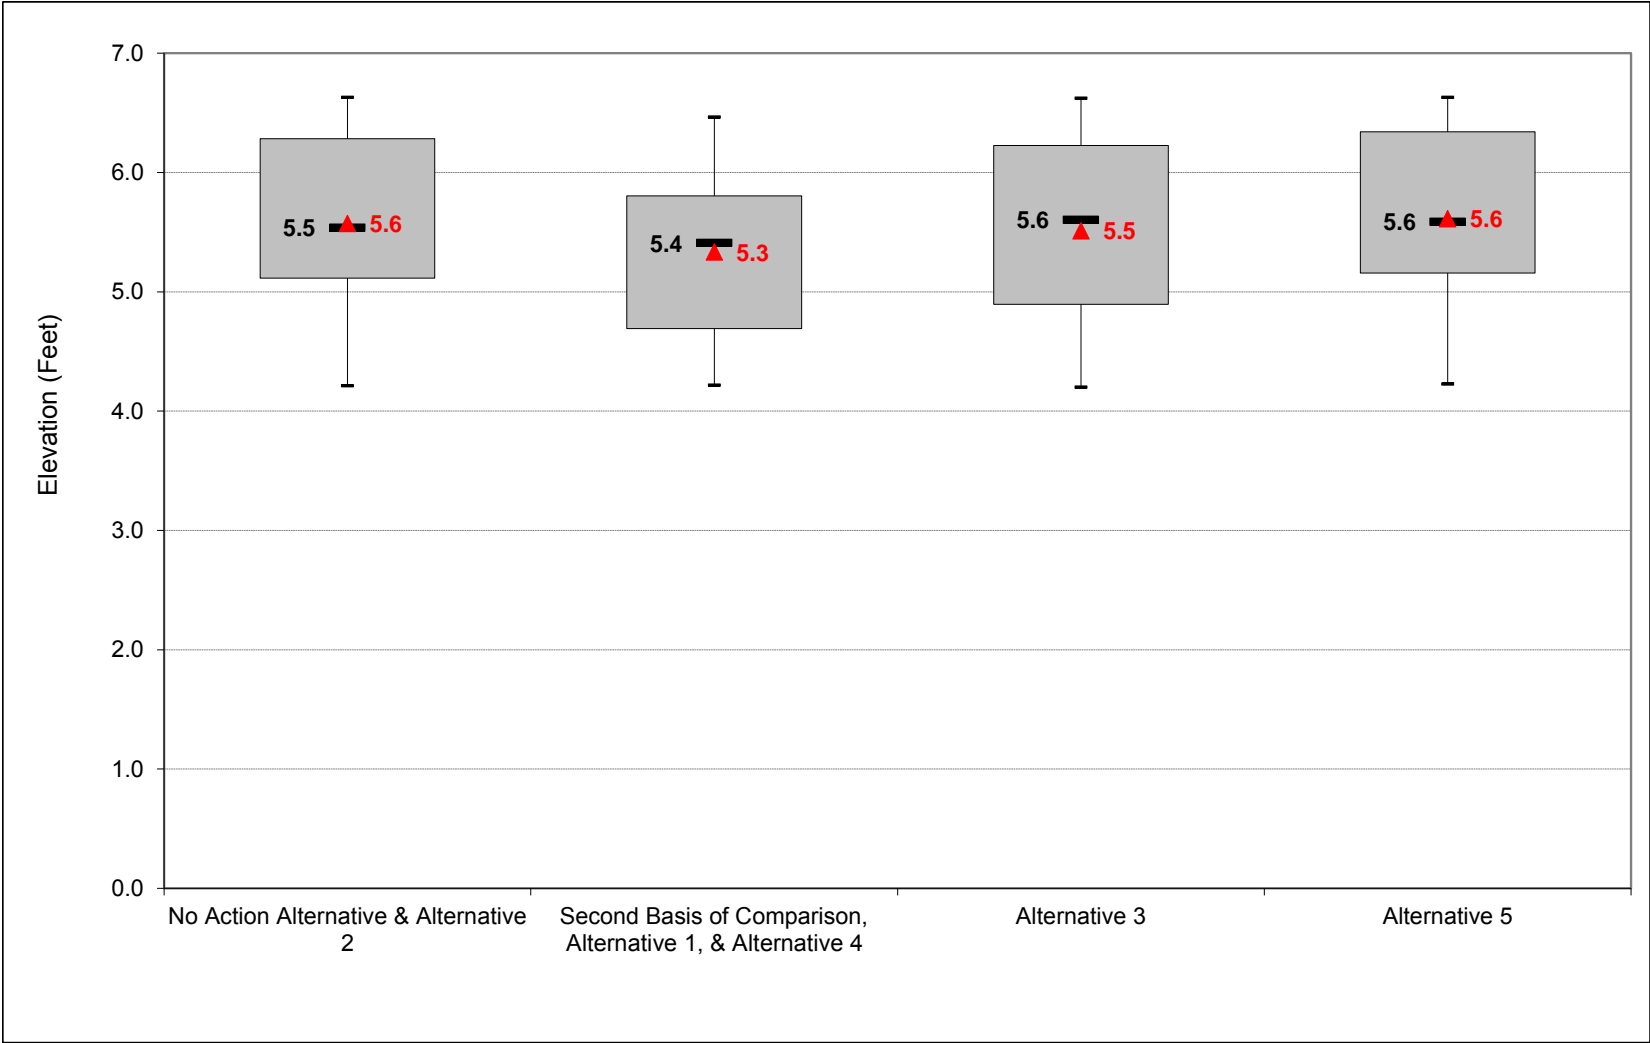

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-43-1-12. Sacramento River at Freeport, Monthly Averaged Daily Maximum Elevation, September

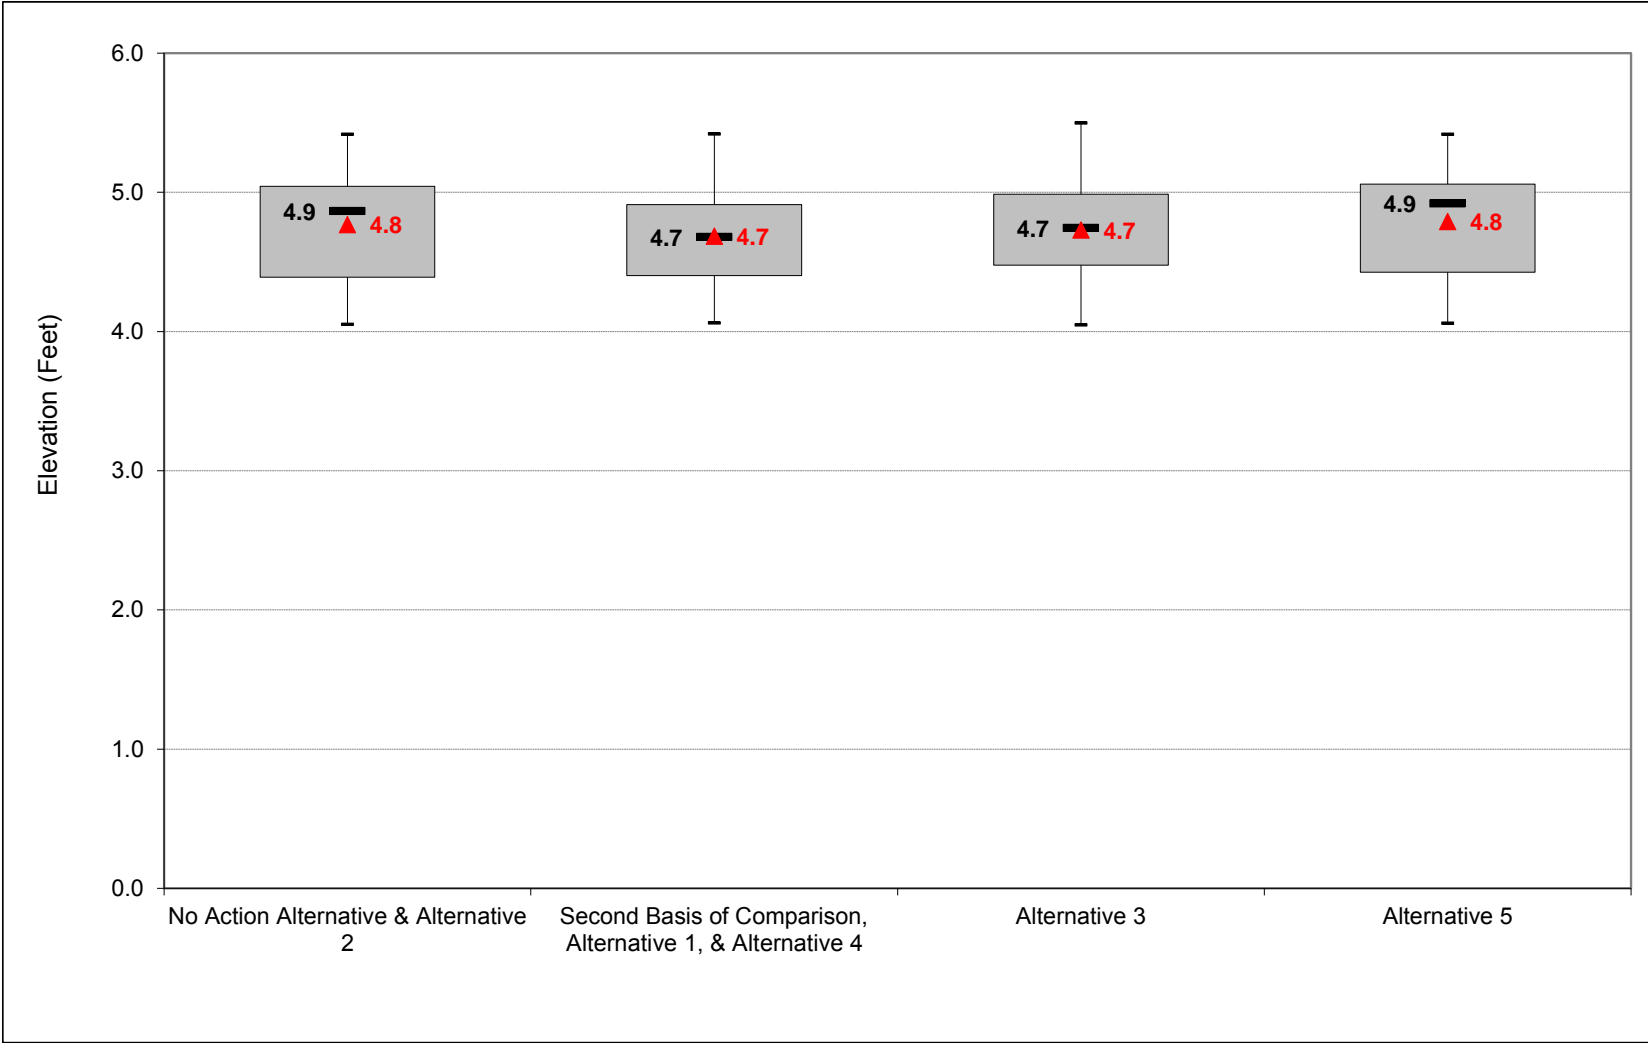

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-43-1-1. Sacramento River at Freeport, Monthly Averaged Daily Maximum Elevation

No Action Alternative												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4.6	6.2	12.0	14.9	16.2	14.5	11.3	9.6	5.7	6.5	5.2	7.5
20%	4.5	5.5	8.3	12.7	14.5	12.2	8.3	6.7	5.0	6.4	5.1	7.3
30%	4.4	5.2	5.9	9.6	12.0	9.2	6.0	5.0	4.7	6.1	5.0	6.2
40%	4.3	4.9	5.2	6.7	10.5	7.5	5.4	4.6	4.7	5.8	4.9	5.7
50%	4.1	4.6	4.9	5.9	8.2	6.4	4.6	4.5	4.6	5.5	4.9	4.7
60%	4.0	4.4	4.8	5.3	6.4	5.6	4.3	4.3	4.5	5.3	4.7	4.4
70%	4.0	4.1	4.6	4.8	5.4	5.2	4.1	4.2	4.5	5.1	4.5	4.3
80%	3.9	4.0	4.3	4.5	4.8	4.4	4.0	4.1	4.3	4.9	4.4	4.2
90%	3.7	3.9	4.2	4.3	4.5	4.0	3.8	4.0	4.2	4.6	4.2	4.0
Long Term												
Full Simulation Period ^b	4.2	5.0	6.5	8.0	9.3	8.0	6.1	5.5	5.0	5.6	4.8	5.4
Water Year Types^c												
Wet (32%)	4.5	5.9	9.2	11.8	13.3	11.5	8.8	7.8	5.9	5.8	5.0	7.3
Above Normal (16%)	4.1	5.4	6.8	9.6	11.3	10.0	6.5	5.2	4.7	6.2	5.1	5.7
Below Normal (13%)	4.3	4.9	5.0	5.5	7.8	5.2	4.5	4.5	4.6	6.0	5.0	4.5
Dry (24%)	4.1	4.4	4.7	5.3	6.4	5.8	4.6	4.3	4.6	5.2	4.4	4.2
Critical (15%)	4.0	4.1	4.5	4.8	4.9	4.3	4.0	4.0	4.3	4.6	4.3	4.1

Alternative 1												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4.6	6.1	13.0	15.2	16.2	14.8	11.3	9.6	5.9	6.2	5.1	4.9
20%	4.4	4.7	8.8	13.4	14.6	12.3	8.3	7.2	5.4	5.9	5.0	4.7
30%	4.3	4.6	6.1	10.2	12.4	10.3	6.0	5.2	5.2	5.7	4.9	4.6
40%	4.2	4.4	5.3	7.1	11.1	7.6	5.4	4.7	5.0	5.6	4.8	4.6
50%	4.1	4.2	4.9	6.2	8.4	6.5	4.7	4.6	4.9	5.4	4.7	4.5
60%	4.1	4.2	4.7	5.3	6.5	5.6	4.3	4.5	4.7	5.2	4.6	4.3
70%	4.0	4.1	4.5	4.8	5.6	5.2	4.2	4.3	4.6	4.8	4.4	4.2
80%	3.9	4.0	4.3	4.5	4.8	4.5	4.0	4.2	4.5	4.6	4.4	4.1
90%	3.8	3.8	4.2	4.3	4.5	4.0	3.8	4.0	4.3	4.5	4.3	4.0
Long Term												
Full Simulation Period ^b	4.2	4.8	6.6	8.1	9.4	8.1	6.1	5.6	5.2	5.3	4.7	4.5
Water Year Types^c												
Wet (32%)	4.4	5.5	9.6	12.1	13.4	11.6	8.8	7.8	6.0	5.6	4.9	4.8
Above Normal (16%)	4.1	5.0	6.7	9.8	11.5	10.4	6.5	5.4	5.1	5.9	5.0	4.6
Below Normal (13%)	4.3	4.6	5.0	5.6	8.2	5.4	4.5	4.7	5.2	5.8	4.8	4.5
Dry (24%)	4.0	4.2	4.6	5.2	6.4	5.9	4.6	4.4	4.8	4.9	4.4	4.3
Critical (15%)	4.0	4.0	4.5	4.8	4.9	4.3	4.0	4.0	4.4	4.5	4.3	4.1

Alternative 1 minus No Action Alternative												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.0	-0.1	1.1	0.3	0.0	0.3	0.0	0.0	0.2	-0.3	-0.1	-2.6
20%	-0.1	-0.8	0.5	0.8	0.1	0.1	0.0	0.5	0.4	-0.5	-0.1	-2.6
30%	-0.1	-0.7	0.1	0.6	0.4	1.0	0.0	0.1	0.5	-0.4	-0.1	-1.6
40%	-0.1	-0.5	0.1	0.4	0.6	0.2	0.0	0.1	0.4	-0.2	-0.1	-1.1
50%	0.0	-0.3	0.0	0.3	0.1	0.0	0.0	0.1	0.3	-0.1	-0.2	-0.2
60%	0.0	-0.2	-0.1	-0.1	0.0	0.0	0.0	0.2	0.2	-0.1	-0.1	-0.1
70%	0.0	-0.1	-0.1	0.0	0.2	0.0	0.0	0.1	0.1	-0.4	-0.1	-0.1
80%	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.1	0.1	-0.3	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	-0.3	0.1	0.1	0.1	0.1	0.0	0.1	0.2	-0.2	-0.1	-1.0
Water Year Types^c												
Wet (32%)	-0.1	-0.3	0.5	0.2	0.1	0.1	0.0	0.0	0.1	-0.2	-0.1	-2.5
Above Normal (16%)	0.0	-0.3	-0.1	0.2	0.2	0.4	0.0	0.2	0.4	-0.2	-0.1	-1.1
Below Normal (13%)	-0.1	-0.3	0.0	0.1	0.3	0.2	0.0	0.3	0.6	-0.3	-0.2	0.0
Dry (24%)	0.0	-0.3	0.0	0.0	0.1	0.0	0.0	0.1	0.2	-0.3	0.0	0.0
Critical (15%)	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-43-1-2. Sacramento River at Freeport, Monthly Averaged Daily Maximum Elevation

No Action Alternative

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	4.6	6.2	12.0	14.9	16.2	14.5	11.3	9.6	5.7	6.5	5.2	7.5
20%	4.5	5.5	8.3	12.7	14.5	12.2	8.3	6.7	5.0	6.4	5.1	7.3
30%	4.4	5.2	5.9	9.6	12.0	9.2	6.0	5.0	4.7	6.1	5.0	6.2
40%	4.3	4.9	5.2	6.7	10.5	7.5	5.4	4.6	4.7	5.8	4.9	5.7
50%	4.1	4.6	4.9	5.9	8.2	6.4	4.6	4.5	4.6	5.5	4.9	4.7
60%	4.0	4.4	4.8	5.3	6.4	5.6	4.3	4.3	4.5	5.3	4.7	4.4
70%	4.0	4.1	4.6	4.8	5.4	5.2	4.1	4.2	4.5	5.1	4.5	4.3
80%	3.9	4.0	4.3	4.5	4.8	4.4	4.0	4.1	4.3	4.9	4.4	4.2
90%	3.7	3.9	4.2	4.3	4.5	4.0	3.8	4.0	4.2	4.6	4.2	4.0
Long Term												
Full Simulation Period ^b	4.2	5.0	6.5	8.0	9.3	8.0	6.1	5.5	5.0	5.6	4.8	5.4
Water Year Types ^c												
Wet (32%)	4.5	5.9	9.2	11.8	13.3	11.5	8.8	7.8	5.9	5.8	5.0	7.3
Above Normal (16%)	4.1	5.4	6.8	9.6	11.3	10.0	6.5	5.2	4.7	6.2	5.1	5.7
Below Normal (13%)	4.3	4.9	5.0	5.5	7.8	5.2	4.5	4.5	4.6	6.0	5.0	4.5
Dry (24%)	4.1	4.4	4.7	5.3	6.4	5.8	4.6	4.3	4.6	5.2	4.4	4.2
Critical (15%)	4.0	4.1	4.5	4.8	4.9	4.3	4.0	4.0	4.3	4.6	4.3	4.1

Alternative 3

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	4.5	6.1	13.0	15.1	16.2	14.8	11.3	9.6	5.7	6.4	5.1	4.8
20%	4.4	4.8	8.9	13.3	14.6	12.3	8.3	6.9	5.3	6.3	5.0	4.7
30%	4.3	4.5	6.1	10.2	12.4	9.7	6.0	5.2	5.1	6.1	4.9	4.6
40%	4.2	4.3	5.3	7.0	11.0	7.6	5.4	4.7	5.0	5.8	4.9	4.6
50%	4.1	4.2	4.9	6.1	8.4	6.5	4.7	4.6	4.8	5.6	4.7	4.5
60%	4.0	4.2	4.7	5.3	6.5	5.7	4.3	4.4	4.8	5.3	4.6	4.4
70%	3.9	4.1	4.5	4.8	5.7	5.2	4.2	4.3	4.7	5.0	4.5	4.2
80%	3.9	4.0	4.3	4.5	4.8	4.5	4.0	4.2	4.5	4.7	4.4	4.2
90%	3.7	3.8	4.2	4.3	4.6	4.0	3.8	4.0	4.3	4.5	4.3	4.1
Long Term												
Full Simulation Period ^b	4.2	4.8	6.6	8.1	9.4	8.1	6.1	5.6	5.2	5.5	4.7	4.5
Water Year Types ^c												
Wet (32%)	4.4	5.5	9.6	12.1	13.4	11.5	8.8	7.9	6.1	5.7	4.9	4.8
Above Normal (16%)	4.1	5.1	6.7	9.7	11.5	10.3	6.5	5.4	5.0	6.1	5.0	4.6
Below Normal (13%)	4.2	4.6	5.0	5.7	8.2	5.4	4.5	4.6	4.9	6.1	5.0	4.6
Dry (24%)	4.0	4.2	4.6	5.2	6.4	5.8	4.6	4.4	4.8	5.1	4.4	4.2
Critical (15%)	4.0	4.0	4.5	4.8	5.0	4.3	4.0	4.0	4.4	4.5	4.3	4.1

Alternative 3 minus No Action Alternative

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.1	0.0	1.0	0.2	0.0	0.3	0.0	0.0	0.0	-0.1	-0.1	-2.7
20%	-0.1	-0.7	0.7	0.7	0.1	0.1	0.0	0.2	0.3	-0.1	0.0	-2.6
30%	-0.1	-0.7	0.2	0.6	0.4	0.5	0.0	0.2	0.4	0.0	-0.1	-1.6
40%	-0.1	-0.6	0.1	0.4	0.5	0.2	0.0	0.1	0.3	0.0	-0.1	-1.1
50%	0.0	-0.4	0.0	0.2	0.1	0.0	0.0	0.1	0.2	0.1	-0.1	-0.2
60%	0.0	-0.2	-0.1	0.0	0.0	0.1	0.0	0.1	0.3	0.0	-0.1	-0.1
70%	0.0	-0.1	-0.1	0.0	0.2	0.0	0.0	0.1	0.2	-0.1	0.0	0.0
80%	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.1	0.2	-0.2	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.0	0.0
Long Term												
Full Simulation Period ^b	-0.1	-0.3	0.1	0.1	0.1	0.1	0.0	0.1	0.2	-0.1	0.0	-1.0
Water Year Types ^c												
Wet (32%)	-0.1	-0.3	0.5	0.3	0.1	0.1	0.0	0.0	0.2	-0.1	-0.1	-2.5
Above Normal (16%)	-0.1	-0.3	-0.1	0.1	0.2	0.3	0.0	0.2	0.3	-0.1	-0.1	-1.1
Below Normal (13%)	-0.1	-0.3	0.0	0.2	0.3	0.2	0.0	0.2	0.3	0.1	0.1	0.1
Dry (24%)	0.0	-0.3	0.0	0.0	0.1	0.0	0.0	0.1	0.2	-0.1	0.0	0.0
Critical (15%)	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-43-1-3. Sacramento River at Freeport, Monthly Averaged Daily Maximum Elevation

No Action Alternative

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4.6	6.2	12.0	14.9	16.2	14.5	11.3	9.6	5.7	6.5	5.2	7.5
20%	4.5	5.5	8.3	12.7	14.5	12.2	8.3	6.7	5.0	6.4	5.1	7.3
30%	4.4	5.2	5.9	9.6	12.0	9.2	6.0	5.0	4.7	6.1	5.0	6.2
40%	4.3	4.9	5.2	6.7	10.5	7.5	5.4	4.6	4.7	5.8	4.9	5.7
50%	4.1	4.6	4.9	5.9	8.2	6.4	4.6	4.5	4.6	5.5	4.9	4.7
60%	4.0	4.4	4.8	5.3	6.4	5.6	4.3	4.3	4.5	5.3	4.7	4.4
70%	4.0	4.1	4.6	4.8	5.4	5.2	4.1	4.2	4.5	5.1	4.5	4.3
80%	3.9	4.0	4.3	4.5	4.8	4.4	4.0	4.1	4.3	4.9	4.4	4.2
90%	3.7	3.9	4.2	4.3	4.5	4.0	3.8	4.0	4.2	4.6	4.2	4.0
Long Term												
Full Simulation Period ^b	4.2	5.0	6.5	8.0	9.3	8.0	6.1	5.5	5.0	5.6	4.8	5.4
Water Year Types^c												
Wet (32%)	4.5	5.9	9.2	11.8	13.3	11.5	8.8	7.8	5.9	5.8	5.0	7.3
Above Normal (16%)	4.1	5.4	6.8	9.6	11.3	10.0	6.5	5.2	4.7	6.2	5.1	5.7
Below Normal (13%)	4.3	4.9	5.0	5.5	7.8	5.2	4.5	4.5	4.6	6.0	5.0	4.5
Dry (24%)	4.1	4.4	4.7	5.3	6.4	5.8	4.6	4.3	4.6	5.2	4.4	4.2
Critical (15%)	4.0	4.1	4.5	4.8	4.9	4.3	4.0	4.0	4.3	4.6	4.3	4.1

Alternative 5

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4.6	6.2	12.0	14.9	16.2	14.5	11.3	9.6	5.7	6.5	5.2	7.5
20%	4.5	5.5	8.3	12.6	14.5	12.2	8.3	6.7	5.0	6.4	5.1	7.3
30%	4.4	5.3	5.9	9.6	12.0	9.2	6.0	5.0	4.8	6.2	5.0	6.2
40%	4.3	4.9	5.2	6.6	10.5	7.5	5.4	4.5	4.7	5.8	5.0	5.7
50%	4.1	4.6	4.9	5.9	8.3	6.4	4.6	4.4	4.6	5.6	4.9	4.7
60%	4.0	4.3	4.8	5.3	6.4	5.6	4.3	4.3	4.5	5.4	4.8	4.5
70%	4.0	4.2	4.6	4.8	5.4	5.2	4.1	4.2	4.5	5.2	4.5	4.3
80%	3.9	4.0	4.3	4.5	4.8	4.4	3.9	4.1	4.3	5.1	4.4	4.2
90%	3.7	3.9	4.2	4.3	4.5	4.0	3.8	3.9	4.2	4.6	4.3	4.0
Long Term												
Full Simulation Period ^b	4.2	5.1	6.5	8.0	9.3	8.0	6.1	5.5	5.0	5.6	4.8	5.4
Water Year Types^c												
Wet (32%)	4.5	5.9	9.2	11.9	13.3	11.5	8.8	7.8	5.9	5.9	5.0	7.2
Above Normal (16%)	4.1	5.4	6.8	9.6	11.3	10.0	6.5	5.2	4.7	6.2	5.1	5.7
Below Normal (13%)	4.3	4.9	5.0	5.5	7.8	5.2	4.5	4.4	4.6	6.1	5.0	4.5
Dry (24%)	4.1	4.4	4.7	5.3	6.4	5.8	4.6	4.2	4.6	5.3	4.5	4.2
Critical (15%)	4.0	4.1	4.5	4.8	4.9	4.3	3.9	4.0	4.3	4.6	4.3	4.1

Alternative 5 minus No Action Alternative

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0
30%	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-0.1	0.0	0.0	0.1	0.0
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.1	0.1	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-43-1-4. Sacramento River at Freeport, Monthly Averaged Daily Maximum Elevation

Second Basis of Comparison												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4.6	6.1	13.0	15.2	16.2	14.8	11.3	9.6	5.9	6.2	5.1	4.9
20%	4.4	4.7	8.8	13.4	14.6	12.3	8.3	7.2	5.4	5.9	5.0	4.7
30%	4.3	4.6	6.1	10.2	12.4	10.3	6.0	5.2	5.2	5.7	4.9	4.6
40%	4.2	4.4	5.3	7.1	11.1	7.6	5.4	4.7	5.0	5.6	4.8	4.6
50%	4.1	4.2	4.9	6.2	8.4	6.5	4.7	4.6	4.9	5.4	4.7	4.5
60%	4.1	4.2	4.7	5.3	6.5	5.6	4.3	4.5	4.7	5.2	4.6	4.3
70%	4.0	4.1	4.5	4.8	5.6	5.2	4.2	4.3	4.6	4.8	4.4	4.2
80%	3.9	4.0	4.3	4.5	4.8	4.5	4.0	4.2	4.5	4.6	4.4	4.1
90%	3.8	3.8	4.2	4.3	4.5	4.0	3.8	4.0	4.3	4.5	4.3	4.0
Long Term												
Full Simulation Period ^b	4.2	4.8	6.6	8.1	9.4	8.1	6.1	5.6	5.2	5.3	4.7	4.5
Water Year Types^c												
Wet (32%)	4.4	5.5	9.6	12.1	13.4	11.6	8.8	7.8	6.0	5.6	4.9	4.8
Above Normal (16%)	4.1	5.0	6.7	9.8	11.5	10.4	6.5	5.4	5.1	5.9	5.0	4.6
Below Normal (13%)	4.3	4.6	5.0	5.6	8.2	5.4	4.5	4.7	5.2	5.8	4.8	4.5
Dry (24%)	4.0	4.2	4.6	5.2	6.4	5.9	4.6	4.4	4.8	4.9	4.4	4.3
Critical (15%)	4.0	4.0	4.5	4.8	4.9	4.3	4.0	4.0	4.4	4.5	4.3	4.1

No Action Alternative												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4.6	6.2	12.0	14.9	16.2	14.5	11.3	9.6	5.7	6.5	5.2	7.5
20%	4.5	5.5	8.3	12.7	14.5	12.2	8.3	6.7	5.0	6.4	5.1	7.3
30%	4.4	5.2	5.9	9.6	12.0	9.2	6.0	5.0	4.7	6.1	5.0	6.2
40%	4.3	4.9	5.2	6.7	10.5	7.5	5.4	4.6	4.7	5.8	4.9	5.7
50%	4.1	4.6	4.9	5.9	8.2	6.4	4.6	4.5	4.6	5.5	4.9	4.7
60%	4.0	4.4	4.8	5.3	6.4	5.6	4.3	4.3	4.5	5.3	4.7	4.4
70%	4.0	4.1	4.6	4.8	5.4	5.2	4.1	4.2	4.5	5.1	4.5	4.3
80%	3.9	4.0	4.3	4.5	4.8	4.4	4.0	4.1	4.3	4.9	4.4	4.2
90%	3.7	3.9	4.2	4.3	4.5	4.0	3.8	4.0	4.2	4.6	4.2	4.0
Long Term												
Full Simulation Period ^b	4.2	5.0	6.5	8.0	9.3	8.0	6.1	5.5	5.0	5.6	4.8	5.4
Water Year Types^c												
Wet (32%)	4.5	5.9	9.2	11.8	13.3	11.5	8.8	7.8	5.9	5.8	5.0	7.3
Above Normal (16%)	4.1	5.4	6.8	9.6	11.3	10.0	6.5	5.2	4.7	6.2	5.1	5.7
Below Normal (13%)	4.3	4.9	5.0	5.5	7.8	5.2	4.5	4.5	4.6	6.0	5.0	4.5
Dry (24%)	4.1	4.4	4.7	5.3	6.4	5.8	4.6	4.3	4.6	5.2	4.4	4.2
Critical (15%)	4.0	4.1	4.5	4.8	4.9	4.3	4.0	4.0	4.3	4.6	4.3	4.1

No Action Alternative minus Second Basis of Comparison												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.0	0.1	-1.1	-0.3	0.0	-0.3	0.0	0.0	-0.2	0.3	0.1	2.6
20%	0.1	0.8	-0.5	-0.8	-0.1	-0.1	0.0	-0.5	-0.4	0.5	0.1	2.6
30%	0.1	0.7	-0.1	-0.6	-0.4	-1.0	0.0	-0.1	-0.5	0.4	0.1	1.6
40%	0.1	0.5	-0.1	-0.4	-0.6	-0.2	0.0	-0.1	-0.4	0.2	0.1	1.1
50%	0.0	0.3	0.0	-0.3	-0.1	0.0	0.0	-0.1	-0.3	0.1	0.2	0.2
60%	0.0	0.2	0.1	0.1	0.0	0.0	0.0	-0.2	-0.2	0.1	0.1	0.1
70%	0.0	0.1	0.1	0.0	-0.2	0.0	0.0	-0.1	-0.1	0.4	0.1	0.1
80%	0.0	0.0	0.1	0.0	0.0	0.0	0.0	-0.1	-0.1	0.3	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.3	-0.1	-0.1	-0.1	-0.1	0.0	-0.1	-0.2	0.2	0.1	1.0
Water Year Types^c												
Wet (32%)	0.1	0.3	-0.5	-0.2	-0.1	-0.1	0.0	0.0	-0.1	0.2	0.1	2.5
Above Normal (16%)	0.0	0.3	0.1	-0.2	-0.2	-0.4	0.0	-0.2	-0.4	0.2	0.1	1.1
Below Normal (13%)	0.1	0.3	0.0	-0.1	-0.3	-0.2	0.0	-0.3	-0.6	0.3	0.2	0.0
Dry (24%)	0.0	0.3	0.0	0.0	-0.1	0.0	0.0	-0.1	-0.2	0.3	0.0	0.0
Critical (15%)	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-43-1-5. Sacramento River at Freeport, Monthly Averaged Daily Maximum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	4.6	6.1	13.0	15.2	16.2	14.8	11.3	9.6	5.9	6.2	5.1	4.9
20%	4.4	4.7	8.8	13.4	14.6	12.3	8.3	7.2	5.4	5.9	5.0	4.7
30%	4.3	4.6	6.1	10.2	12.4	10.3	6.0	5.2	5.2	5.7	4.9	4.6
40%	4.2	4.4	5.3	7.1	11.1	7.6	5.4	4.7	5.0	5.6	4.8	4.6
50%	4.1	4.2	4.9	6.2	8.4	6.5	4.7	4.6	4.9	5.4	4.7	4.5
60%	4.1	4.2	4.7	5.3	6.5	5.6	4.3	4.5	4.7	5.2	4.6	4.3
70%	4.0	4.1	4.5	4.8	5.6	5.2	4.2	4.3	4.6	4.8	4.4	4.2
80%	3.9	4.0	4.3	4.5	4.8	4.5	4.0	4.2	4.5	4.6	4.4	4.1
90%	3.8	3.8	4.2	4.3	4.5	4.0	3.8	4.0	4.3	4.5	4.3	4.0
Long Term												
Full Simulation Period ^b	4.2	4.8	6.6	8.1	9.4	8.1	6.1	5.6	5.2	5.3	4.7	4.5
Water Year Types ^c												
Wet (32%)	4.4	5.5	9.6	12.1	13.4	11.6	8.8	7.8	6.0	5.6	4.9	4.8
Above Normal (16%)	4.1	5.0	6.7	9.8	11.5	10.4	6.5	5.4	5.1	5.9	5.0	4.6
Below Normal (13%)	4.3	4.6	5.0	5.6	8.2	5.4	4.5	4.7	5.2	5.8	4.8	4.5
Dry (24%)	4.0	4.2	4.6	5.2	6.4	5.9	4.6	4.4	4.8	4.9	4.4	4.3
Critical (15%)	4.0	4.0	4.5	4.8	4.9	4.3	4.0	4.0	4.4	4.5	4.3	4.1

Alternative 3

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	4.5	6.1	13.0	15.1	16.2	14.8	11.3	9.6	5.7	6.4	5.1	4.8
20%	4.4	4.8	8.9	13.3	14.6	12.3	8.3	6.9	5.3	6.3	5.0	4.7
30%	4.3	4.5	6.1	10.2	12.4	9.7	6.0	5.2	5.1	6.1	4.9	4.6
40%	4.2	4.3	5.3	7.0	11.0	7.6	5.4	4.7	5.0	5.8	4.9	4.6
50%	4.1	4.2	4.9	6.1	8.4	6.5	4.7	4.6	4.8	5.6	4.7	4.5
60%	4.0	4.2	4.7	5.3	6.5	5.7	4.3	4.4	4.8	5.3	4.6	4.4
70%	3.9	4.1	4.5	4.8	5.7	5.2	4.2	4.3	4.7	5.0	4.5	4.2
80%	3.9	4.0	4.3	4.5	4.8	4.5	4.0	4.2	4.5	4.7	4.4	4.2
90%	3.7	3.8	4.2	4.3	4.6	4.0	3.8	4.0	4.3	4.5	4.3	4.1
Long Term												
Full Simulation Period ^b	4.2	4.8	6.6	8.1	9.4	8.1	6.1	5.6	5.2	5.5	4.7	4.5
Water Year Types ^c												
Wet (32%)	4.4	5.5	9.6	12.1	13.4	11.5	8.8	7.9	6.1	5.7	4.9	4.8
Above Normal (16%)	4.1	5.1	6.7	9.7	11.5	10.3	6.5	5.4	5.0	6.1	5.0	4.6
Below Normal (13%)	4.2	4.6	5.0	5.7	8.2	5.4	4.5	4.6	4.9	6.1	5.0	4.6
Dry (24%)	4.0	4.2	4.6	5.2	6.4	5.8	4.6	4.4	4.8	5.1	4.4	4.2
Critical (15%)	4.0	4.0	4.5	4.8	5.0	4.3	4.0	4.0	4.4	4.5	4.3	4.1

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.1	0.0	-0.1	0.0	0.0	0.0	0.0	-0.2	0.2	0.0	0.0
20%	0.0	0.1	0.2	-0.1	0.0	0.0	0.0	-0.3	-0.1	0.4	0.1	0.0
30%	0.0	0.0	0.0	0.0	0.0	0.0	-0.5	0.0	0.0	-0.1	0.4	0.1
40%	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	-0.1	0.2	0.1	0.0
50%	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	-0.1	0.2	0.1	0.0
60%	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
70%	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.1	0.2	0.1	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	-0.1	0.0	-0.1	0.0	0.0	-0.1	0.2	0.0	0.0
Below Normal (13%)	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.4	0.4	0.3	0.1
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-43-1-6. Sacramento River at Freeport, Monthly Averaged Daily Maximum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	4.6	6.1	13.0	15.2	16.2	14.8	11.3	9.6	5.9	6.2	5.1	4.9
20%	4.4	4.7	8.8	13.4	14.6	12.3	8.3	7.2	5.4	5.9	5.0	4.7
30%	4.3	4.6	6.1	10.2	12.4	10.3	6.0	5.2	5.2	5.7	4.9	4.6
40%	4.2	4.4	5.3	7.1	11.1	7.6	5.4	4.7	5.0	5.6	4.8	4.6
50%	4.1	4.2	4.9	6.2	8.4	6.5	4.7	4.6	4.9	5.4	4.7	4.5
60%	4.1	4.2	4.7	5.3	6.5	5.6	4.3	4.5	4.7	5.2	4.6	4.3
70%	4.0	4.1	4.5	4.8	5.6	5.2	4.2	4.3	4.6	4.8	4.4	4.2
80%	3.9	4.0	4.3	4.5	4.8	4.5	4.0	4.2	4.5	4.6	4.4	4.1
90%	3.8	3.8	4.2	4.3	4.5	4.0	3.8	4.0	4.3	4.5	4.3	4.0
Long Term												
Full Simulation Period ^b	4.2	4.8	6.6	8.1	9.4	8.1	6.1	5.6	5.2	5.3	4.7	4.5
Water Year Types ^c												
Wet (32%)	4.4	5.5	9.6	12.1	13.4	11.6	8.8	7.8	6.0	5.6	4.9	4.8
Above Normal (16%)	4.1	5.0	6.7	9.8	11.5	10.4	6.5	5.4	5.1	5.9	5.0	4.6
Below Normal (13%)	4.3	4.6	5.0	5.6	8.2	5.4	4.5	4.7	5.2	5.8	4.8	4.5
Dry (24%)	4.0	4.2	4.6	5.2	6.4	5.9	4.6	4.4	4.8	4.9	4.4	4.3
Critical (15%)	4.0	4.0	4.5	4.8	4.9	4.3	4.0	4.0	4.4	4.5	4.3	4.1

Alternative 5

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	4.6	6.2	12.0	14.9	16.2	14.5	11.3	9.6	5.7	6.5	5.2	7.5
20%	4.5	5.5	8.3	12.6	14.5	12.2	8.3	6.7	5.0	6.4	5.1	7.3
30%	4.4	5.3	5.9	9.6	12.0	9.2	6.0	5.0	4.8	6.2	5.0	6.2
40%	4.3	4.9	5.2	6.6	10.5	7.5	5.4	4.5	4.7	5.8	5.0	5.7
50%	4.1	4.6	4.9	5.9	8.3	6.4	4.6	4.4	4.6	5.6	4.9	4.7
60%	4.0	4.3	4.8	5.3	6.4	5.6	4.3	4.3	4.5	5.4	4.8	4.5
70%	4.0	4.2	4.6	4.8	5.4	5.2	4.1	4.2	4.5	5.2	4.5	4.3
80%	3.9	4.0	4.3	4.5	4.8	4.4	3.9	4.1	4.3	5.1	4.4	4.2
90%	3.7	3.9	4.2	4.3	4.5	4.0	3.8	3.9	4.2	4.6	4.3	4.0
Long Term												
Full Simulation Period ^b	4.2	5.1	6.5	8.0	9.3	8.0	6.1	5.5	5.0	5.6	4.8	5.4
Water Year Types ^c												
Wet (32%)	4.5	5.9	9.2	11.9	13.3	11.5	8.8	7.8	5.9	5.9	5.0	7.2
Above Normal (16%)	4.1	5.4	6.8	9.6	11.3	10.0	6.5	5.2	4.7	6.2	5.1	5.7
Below Normal (13%)	4.3	4.9	5.0	5.5	7.8	5.2	4.5	4.4	4.6	6.1	5.0	4.5
Dry (24%)	4.1	4.4	4.7	5.3	6.4	5.8	4.6	4.2	4.6	5.3	4.5	4.2
Critical (15%)	4.0	4.1	4.5	4.8	4.9	4.3	3.9	4.0	4.3	4.6	4.3	4.1

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.1	-1.1	-0.3	0.0	-0.3	0.0	0.0	-0.2	0.3	0.1	2.6
20%	0.1	0.8	-0.5	-0.8	-0.1	-0.1	0.0	-0.5	-0.5	0.5	0.1	2.6
30%	0.1	0.7	-0.1	-0.6	-0.4	-1.0	0.0	-0.1	-0.5	0.5	0.1	1.6
40%	0.1	0.5	-0.1	-0.4	-0.6	-0.2	0.0	-0.1	-0.4	0.2	0.2	1.1
50%	0.0	0.3	0.0	-0.3	-0.1	-0.1	0.0	-0.2	-0.3	0.2	0.2	0.2
60%	0.0	0.2	0.1	0.0	0.0	-0.1	0.0	-0.2	-0.2	0.2	0.2	0.1
70%	0.0	0.1	0.1	0.0	-0.2	0.0	0.0	-0.1	-0.1	0.4	0.1	0.1
80%	0.0	0.0	0.1	0.0	0.0	0.0	0.0	-0.1	-0.2	0.4	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.1	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.3	-0.1	-0.1	-0.1	-0.1	0.0	-0.1	-0.2	0.3	0.1	1.0
Water Year Types ^c												
Wet (32%)	0.1	0.3	-0.5	-0.2	-0.1	-0.1	0.0	0.0	-0.1	0.3	0.1	2.5
Above Normal (16%)	0.0	0.3	0.1	-0.2	-0.2	-0.4	0.0	-0.2	-0.4	0.2	0.1	1.1
Below Normal (13%)	0.0	0.3	0.0	-0.1	-0.3	-0.2	0.0	-0.3	-0.7	0.3	0.2	0.0
Dry (24%)	0.0	0.3	0.0	0.0	-0.1	0.0	0.0	-0.2	-0.2	0.4	0.0	0.0
Critical (15%)	-0.1	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	-0.1	0.1	0.0	0.0


a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-43-2-1. Sacramento River at Freeport, Monthly Averaged Daily Minimum Elevation, October

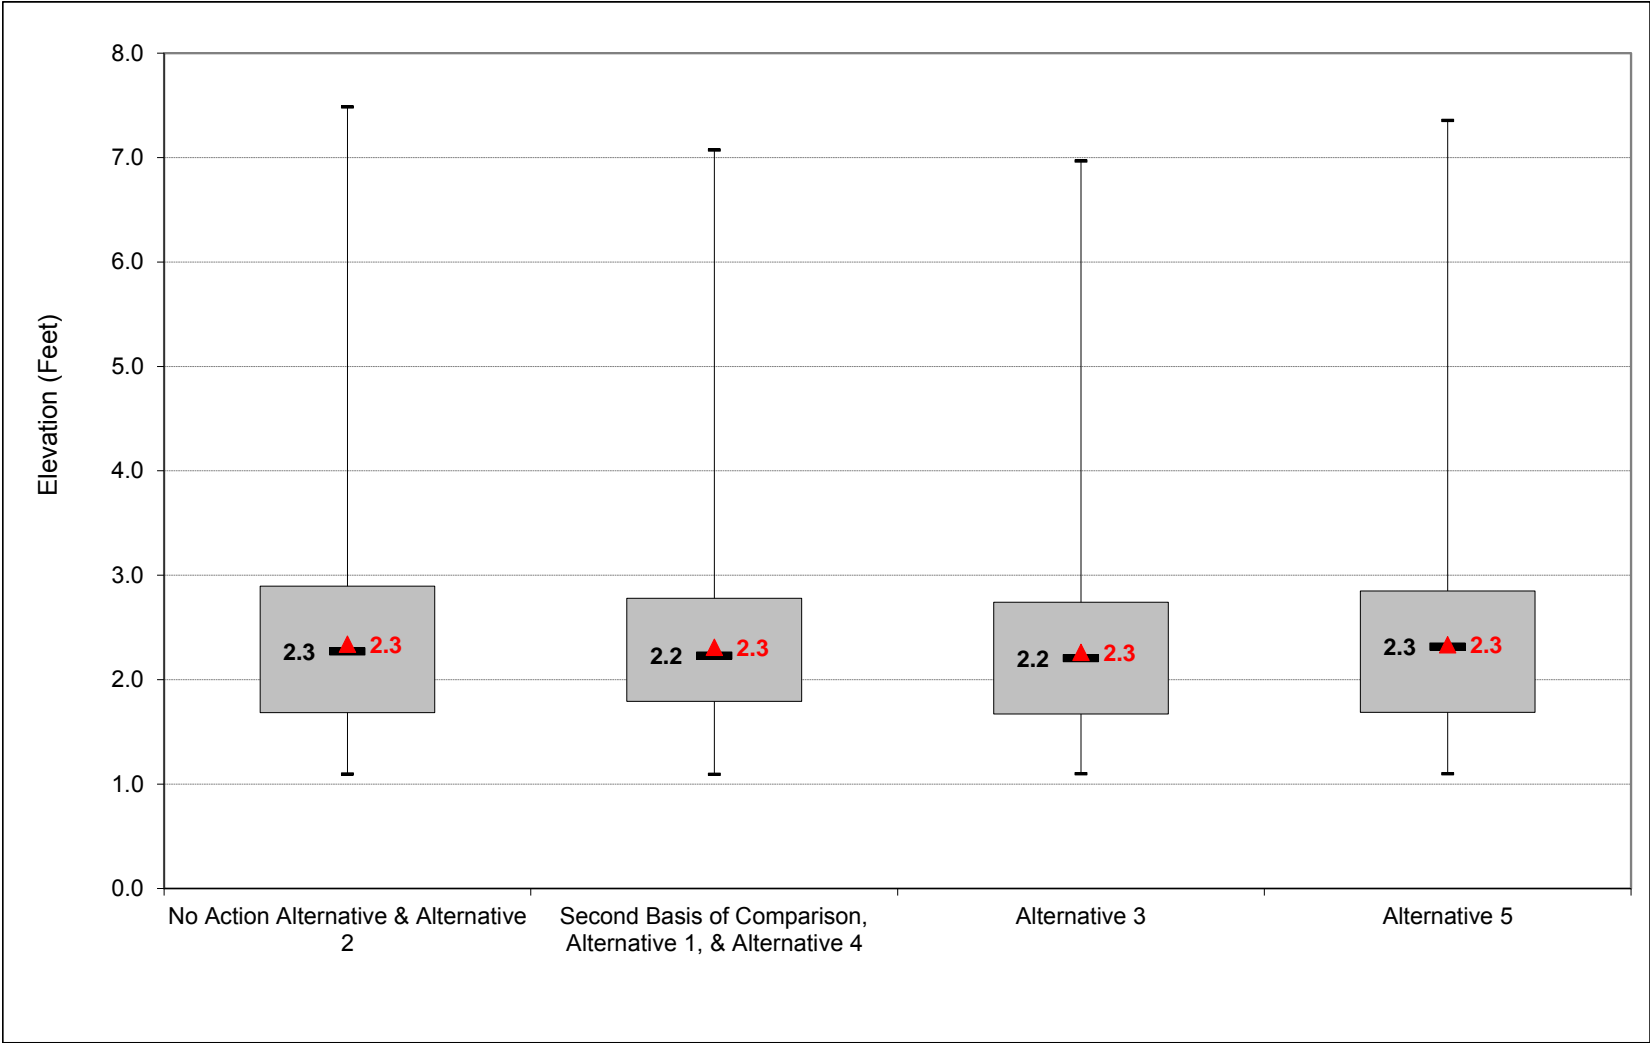


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-43-2-2. Sacramento River at Freeport, Monthly Averaged Daily Minimum Elevation, November

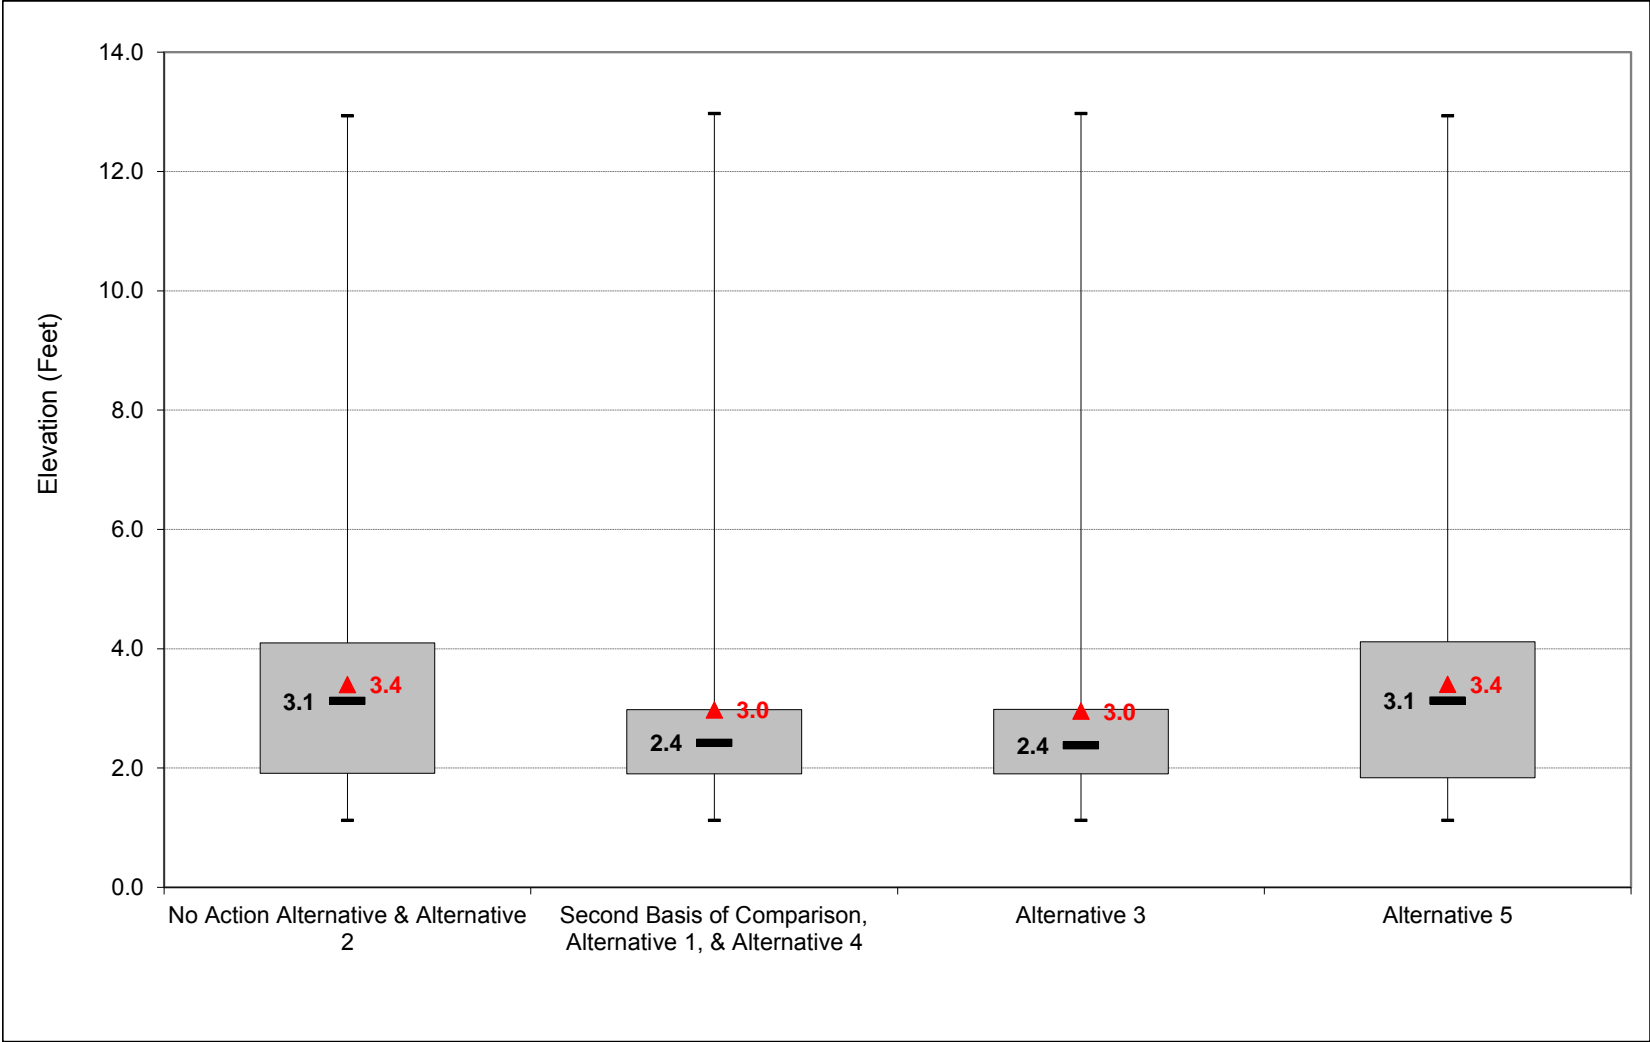


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-43-2-3. Sacramento River at Freeport, Monthly Averaged Daily Minimum Elevation, December

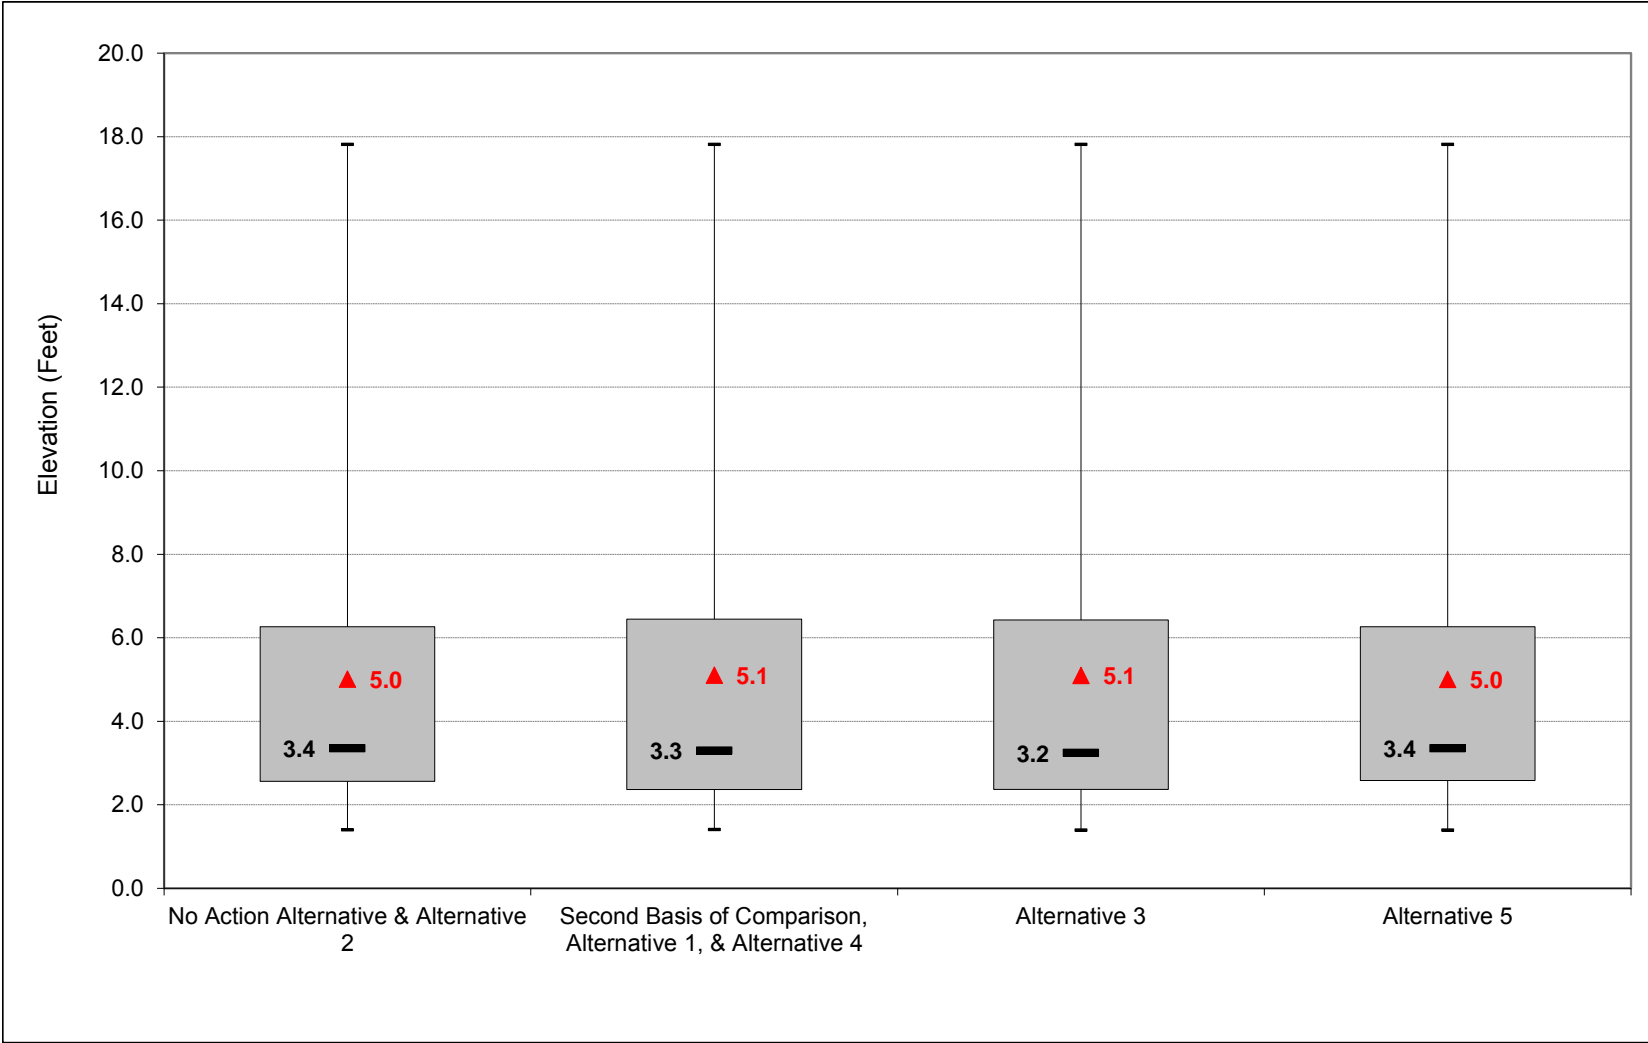


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-43-2-4. Sacramento River at Freeport, Monthly Averaged Daily Minimum Elevation, January

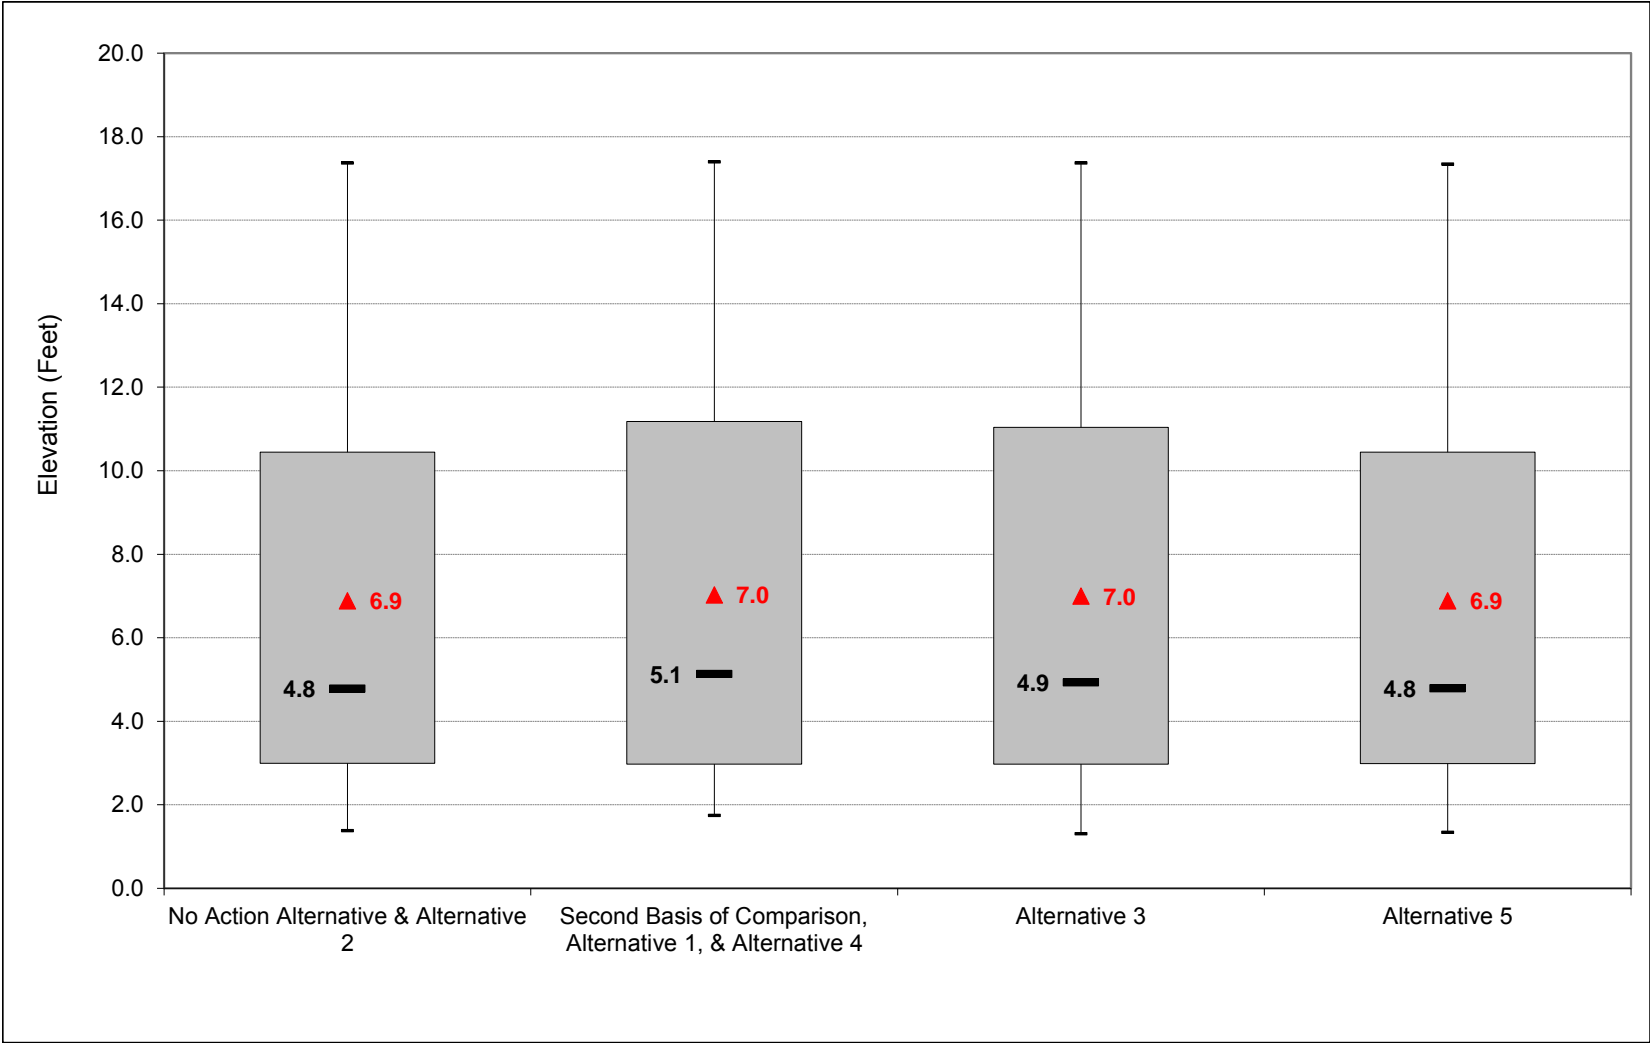


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-43-2-5. Sacramento River at Freeport, Monthly Averaged Daily Minimum Elevation, February

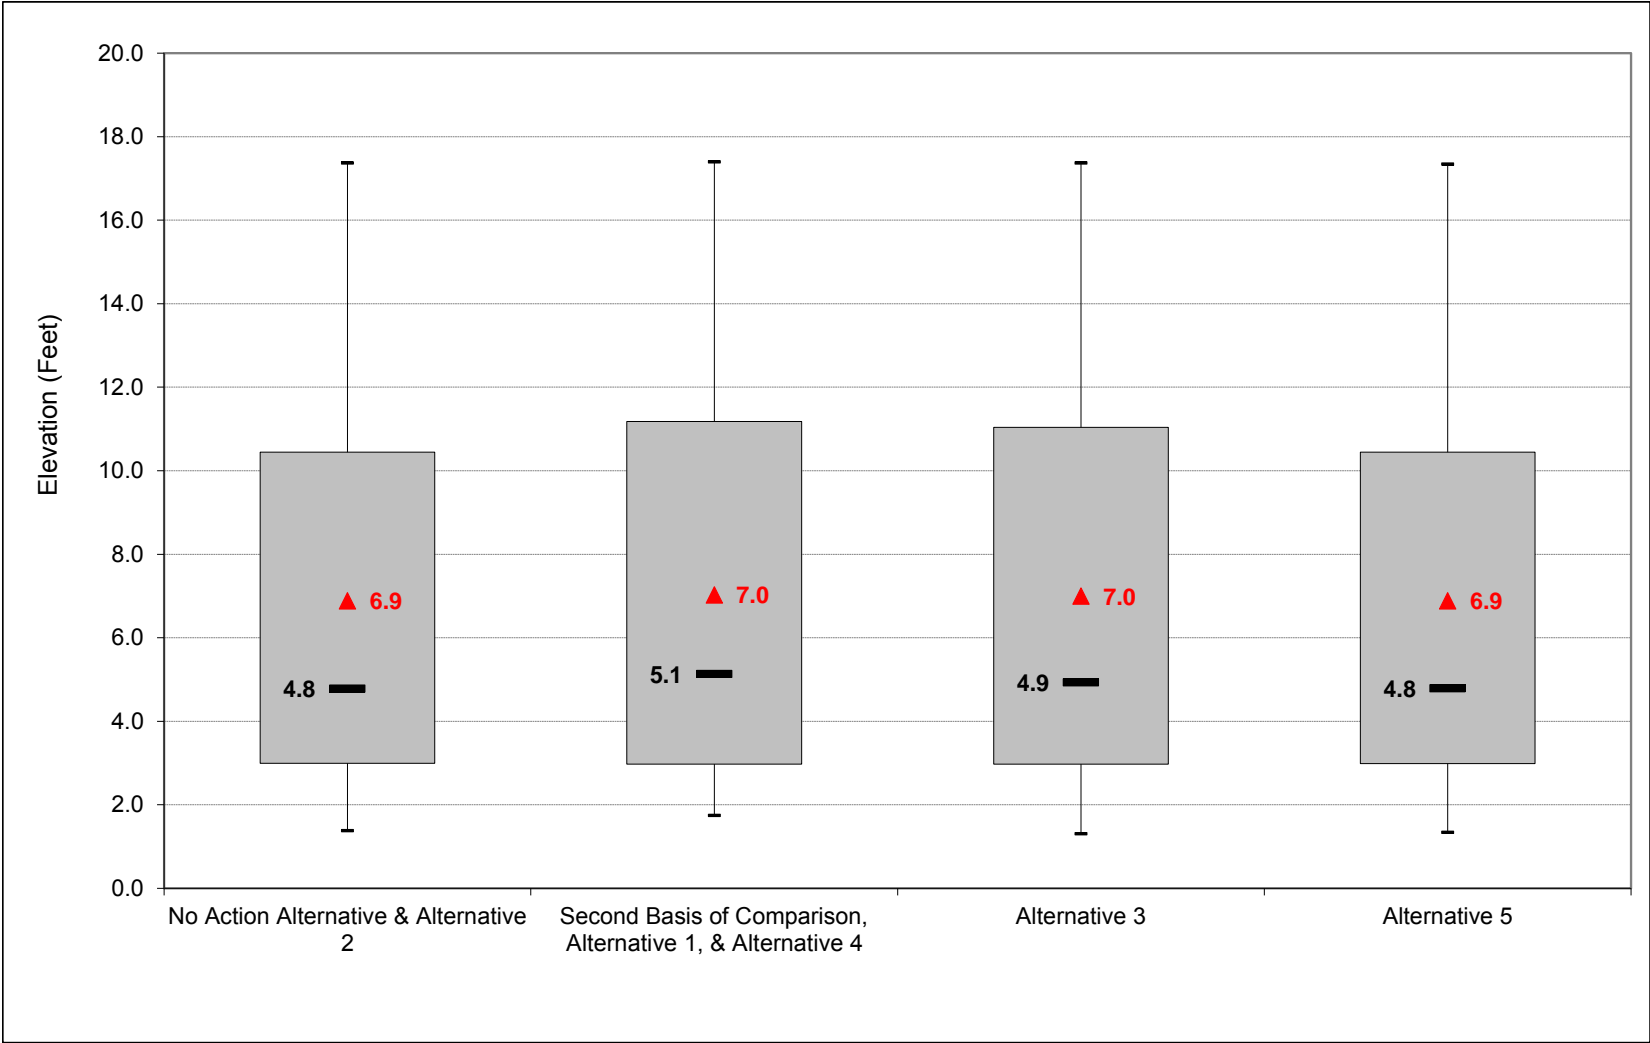


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-43-2-6. Sacramento River at Freeport, Monthly Averaged Daily Minimum Elevation, March

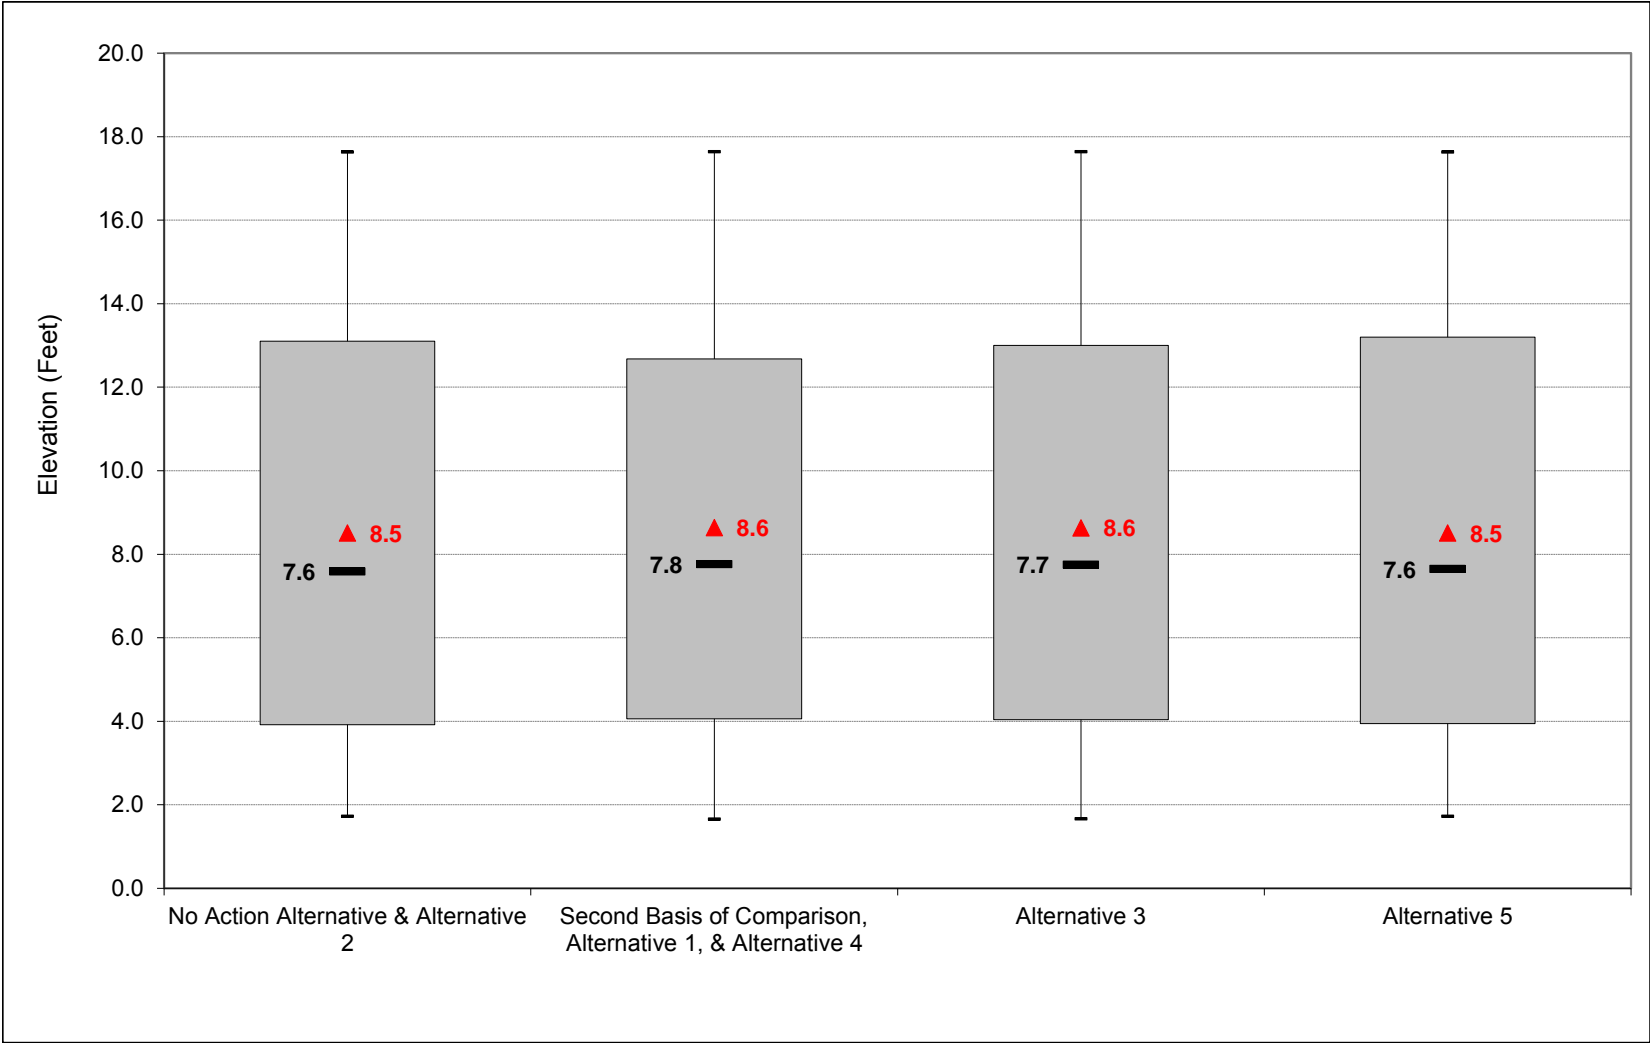


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-43-2-7. Sacramento River at Freeport, Monthly Averaged Daily Minimum Elevation, April

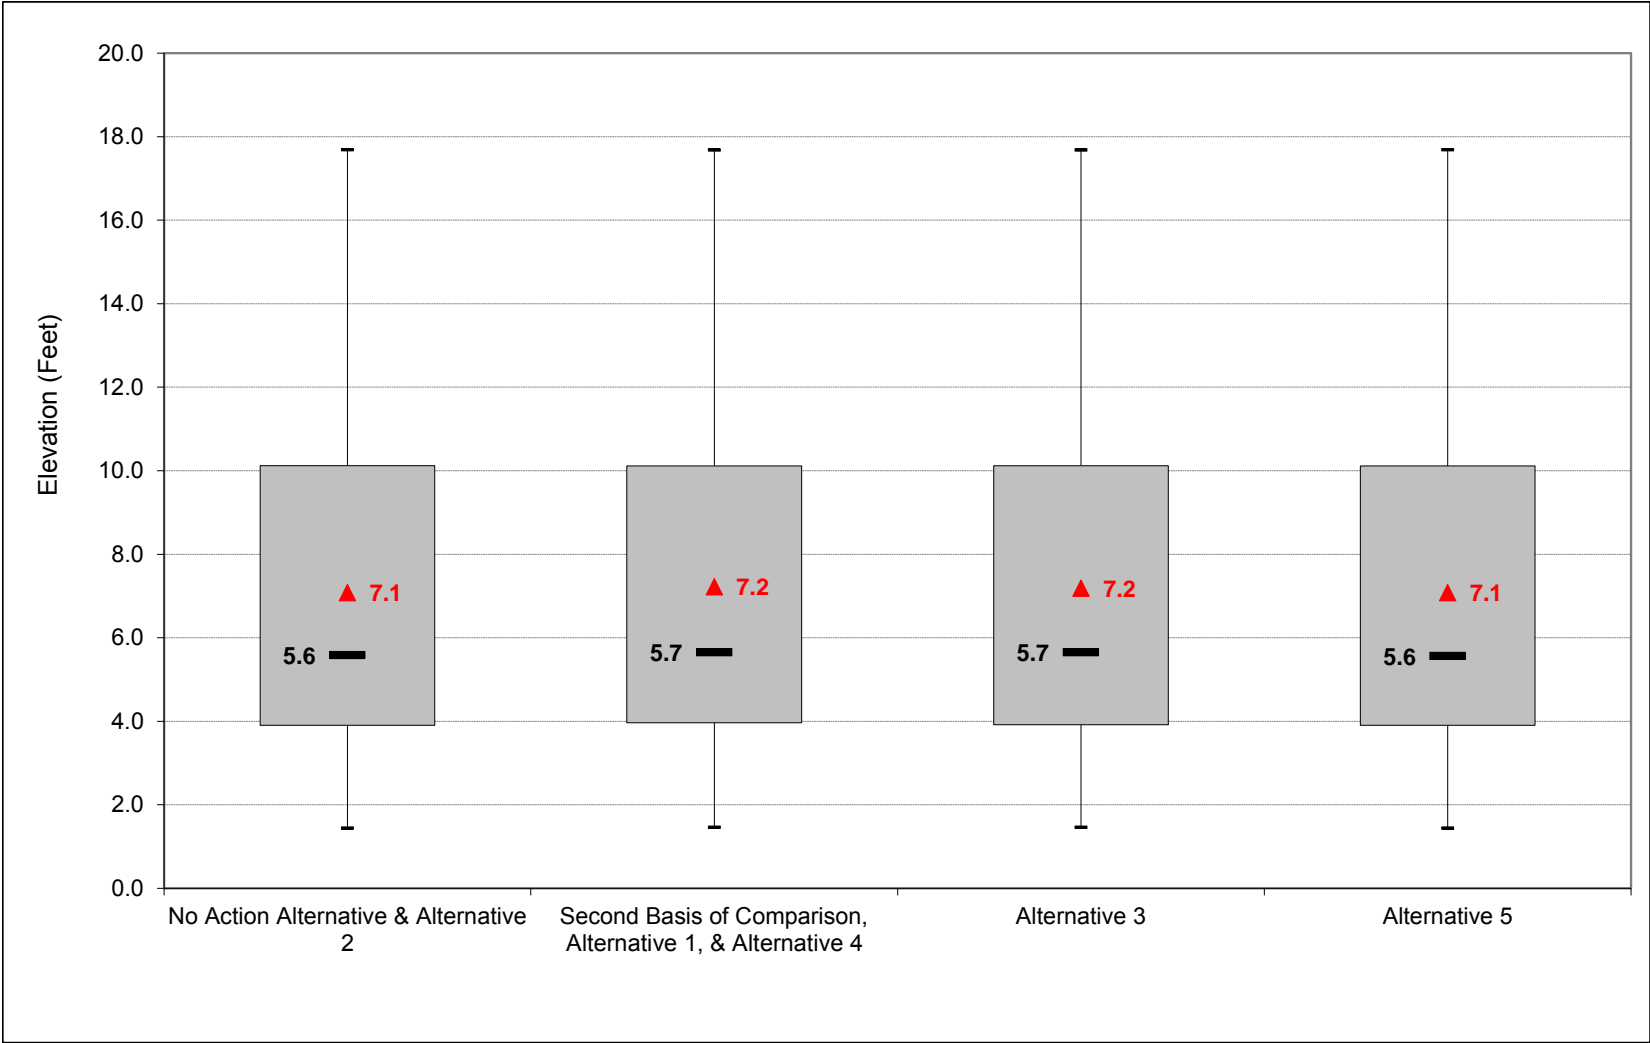


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-43-2-8. Sacramento River at Freeport, Monthly Averaged Daily Minimum Elevation, May

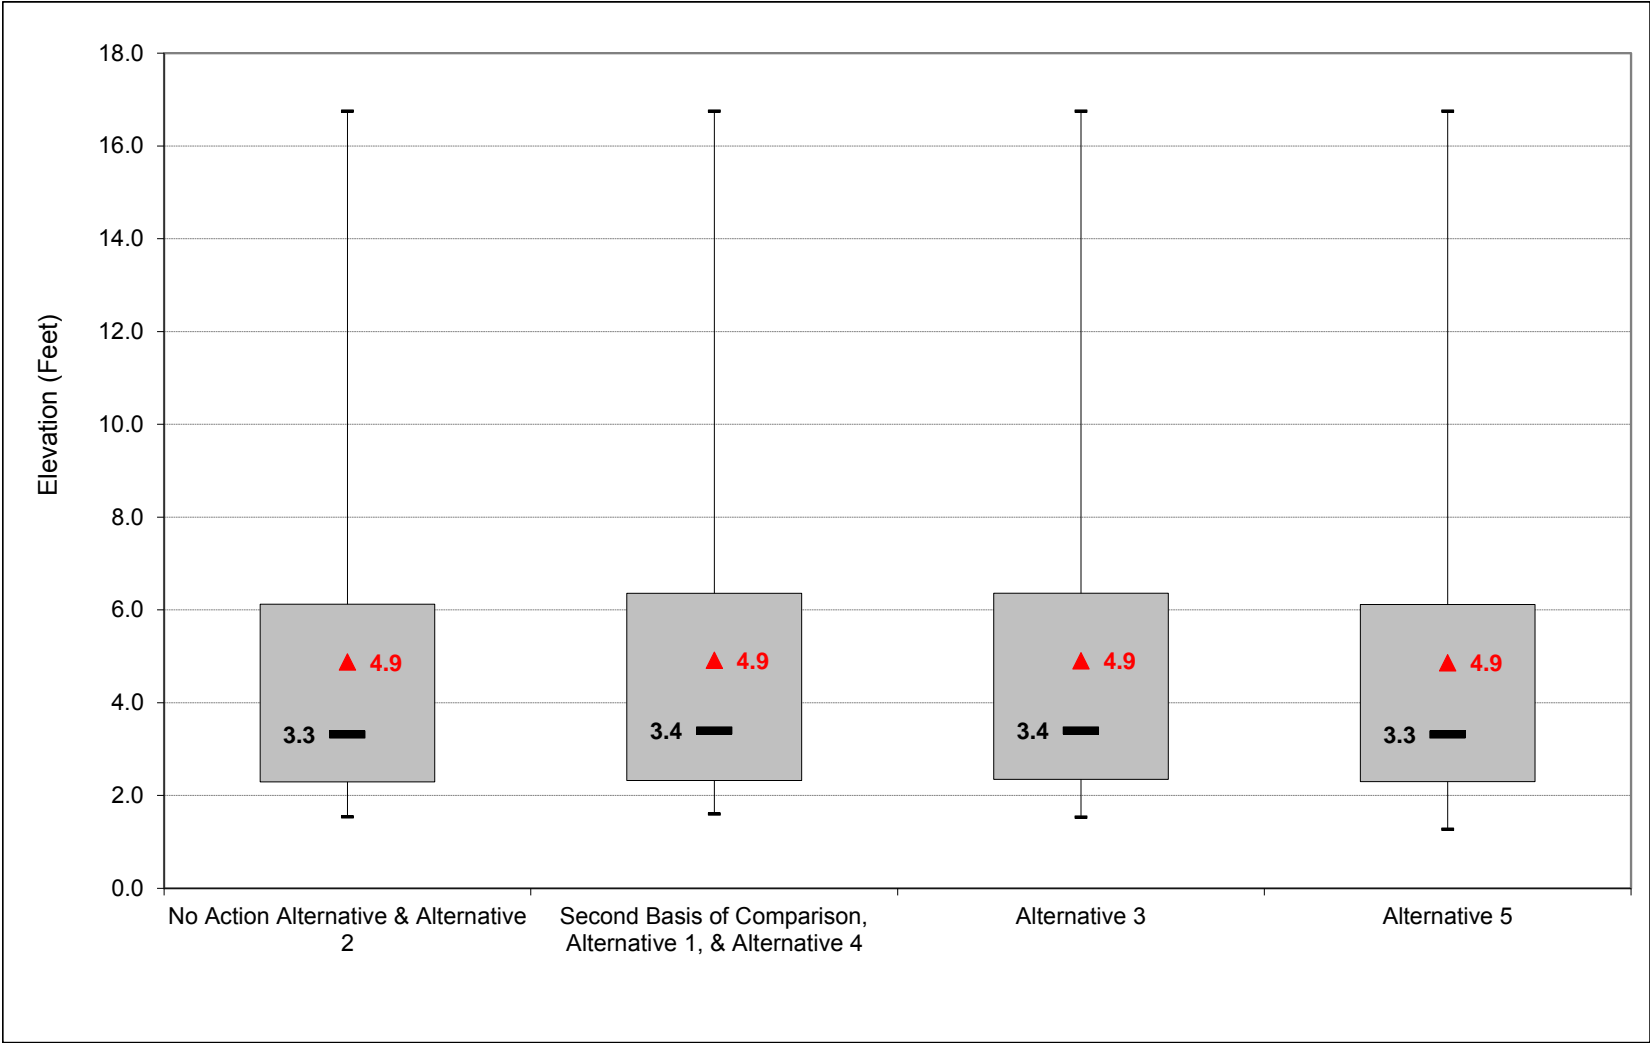


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-43-2-9. Sacramento River at Freeport, Monthly Averaged Daily Minimum Elevation, June

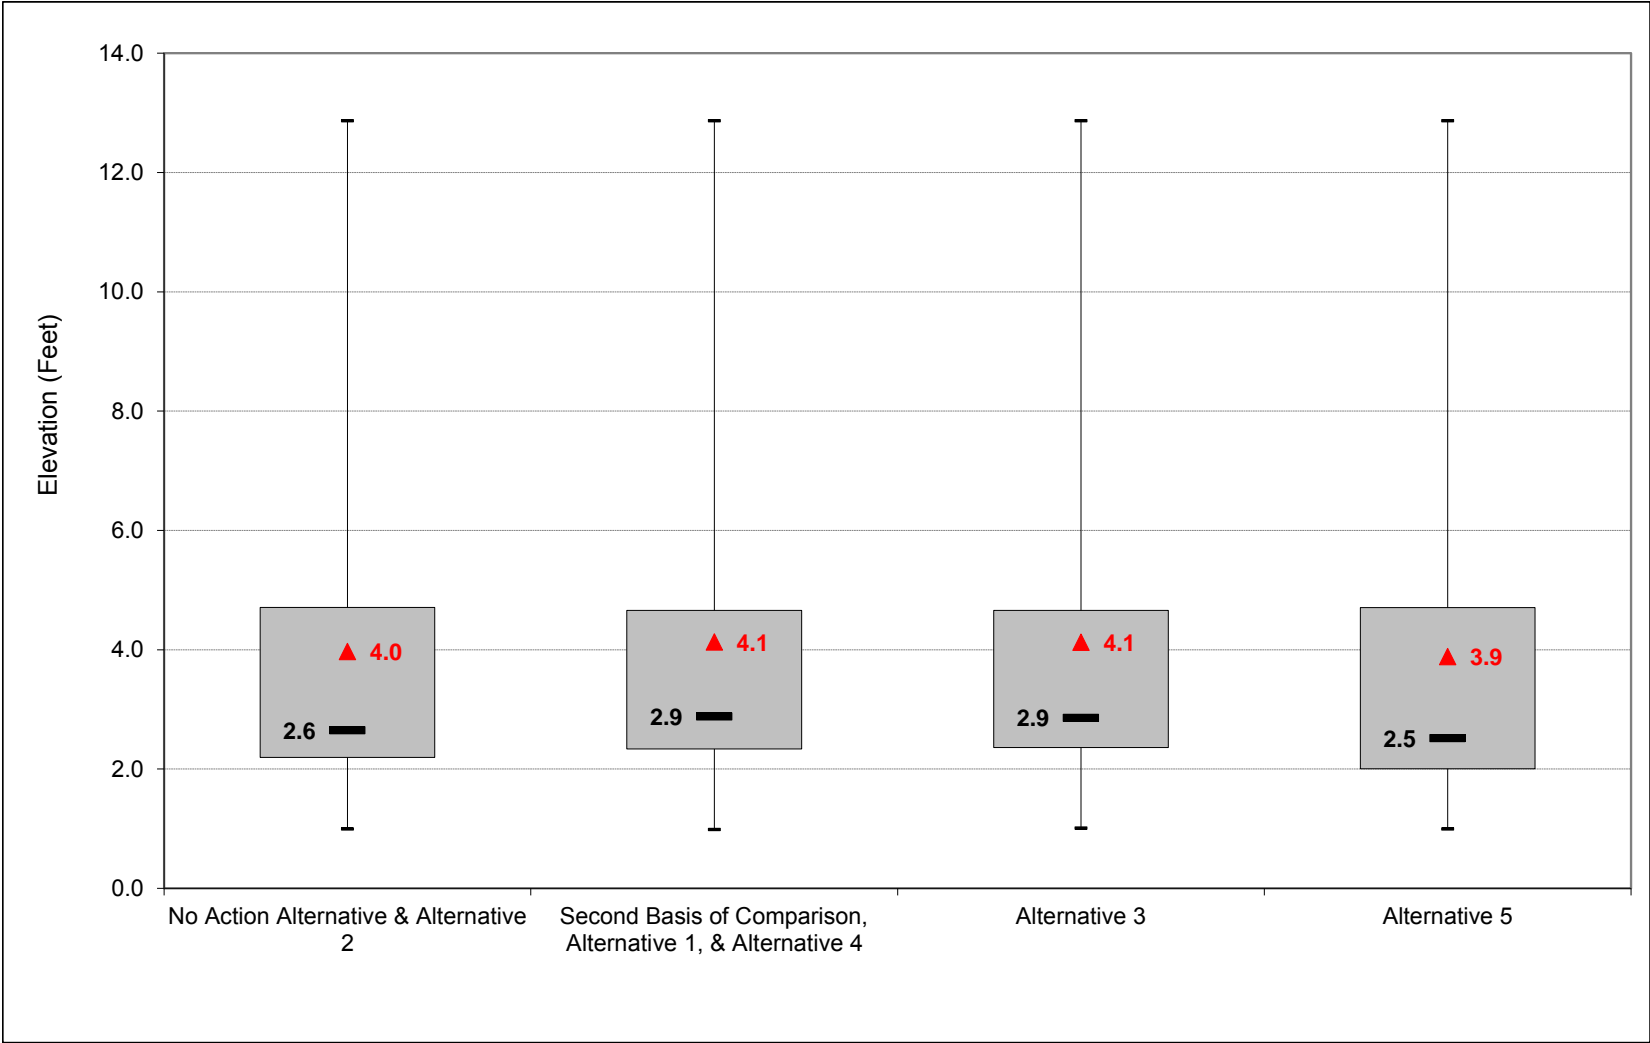


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-43-2-10. Sacramento River at Freeport, Monthly Averaged Daily Minimum Elevation, July

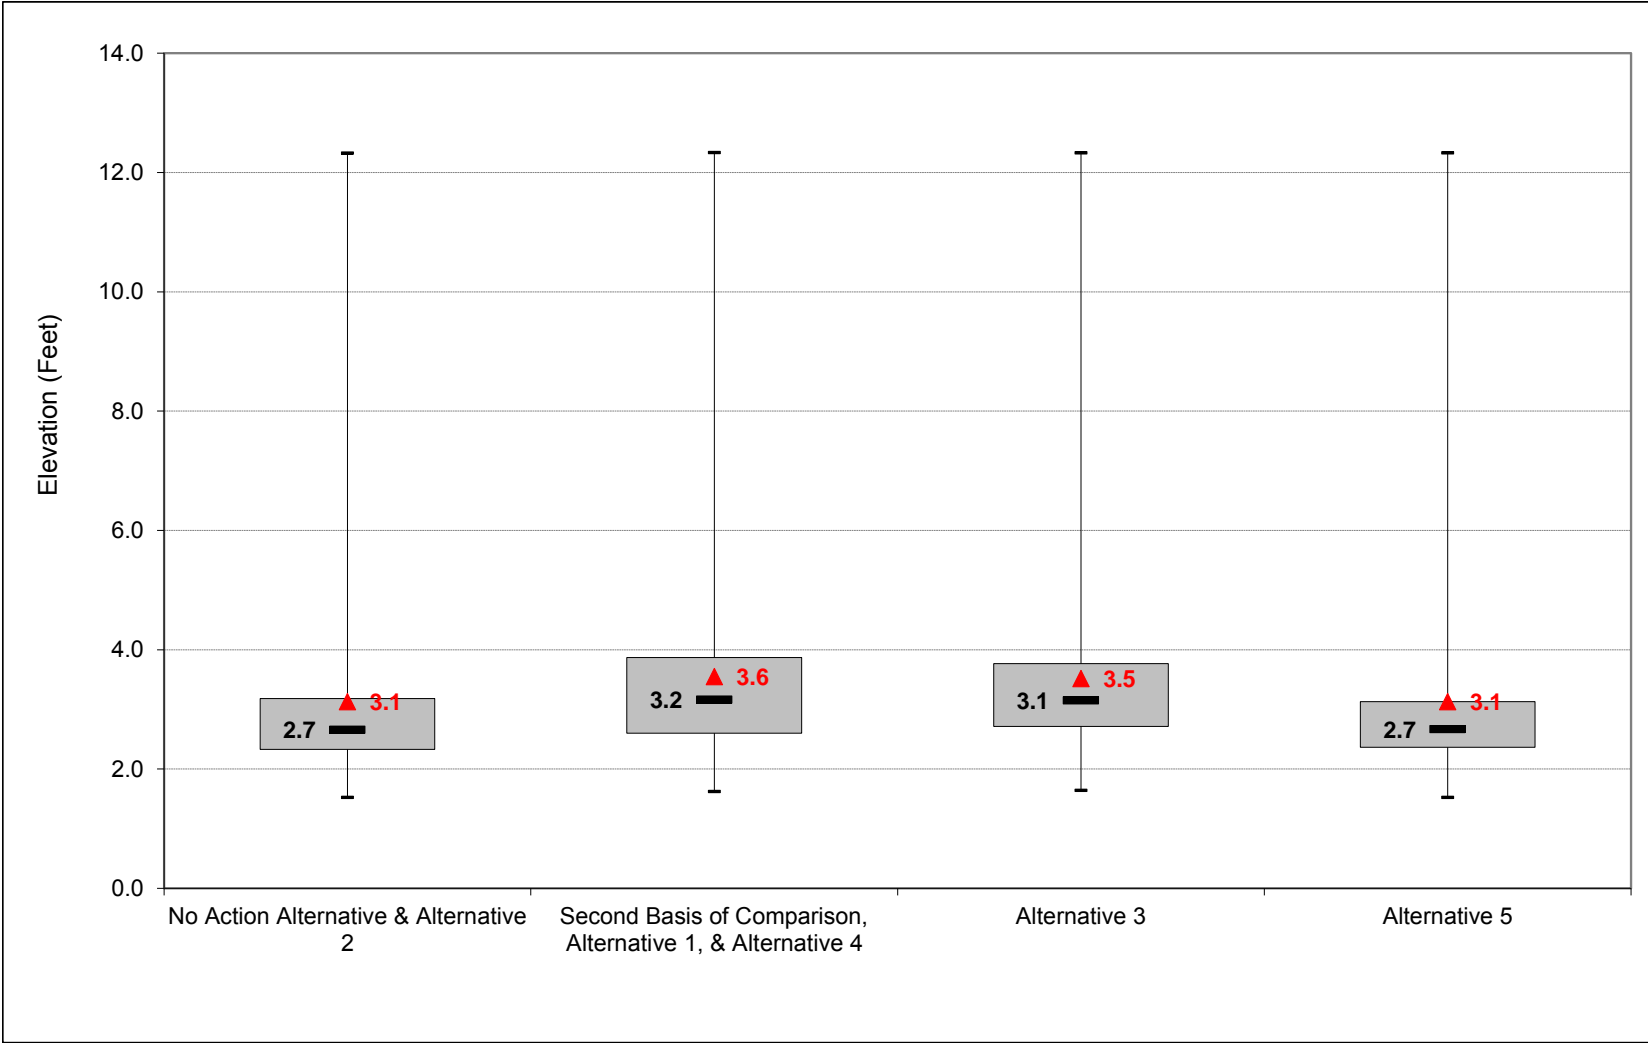


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-43-2-11. Sacramento River at Freeport, Monthly Averaged Daily Minimum Elevation, August

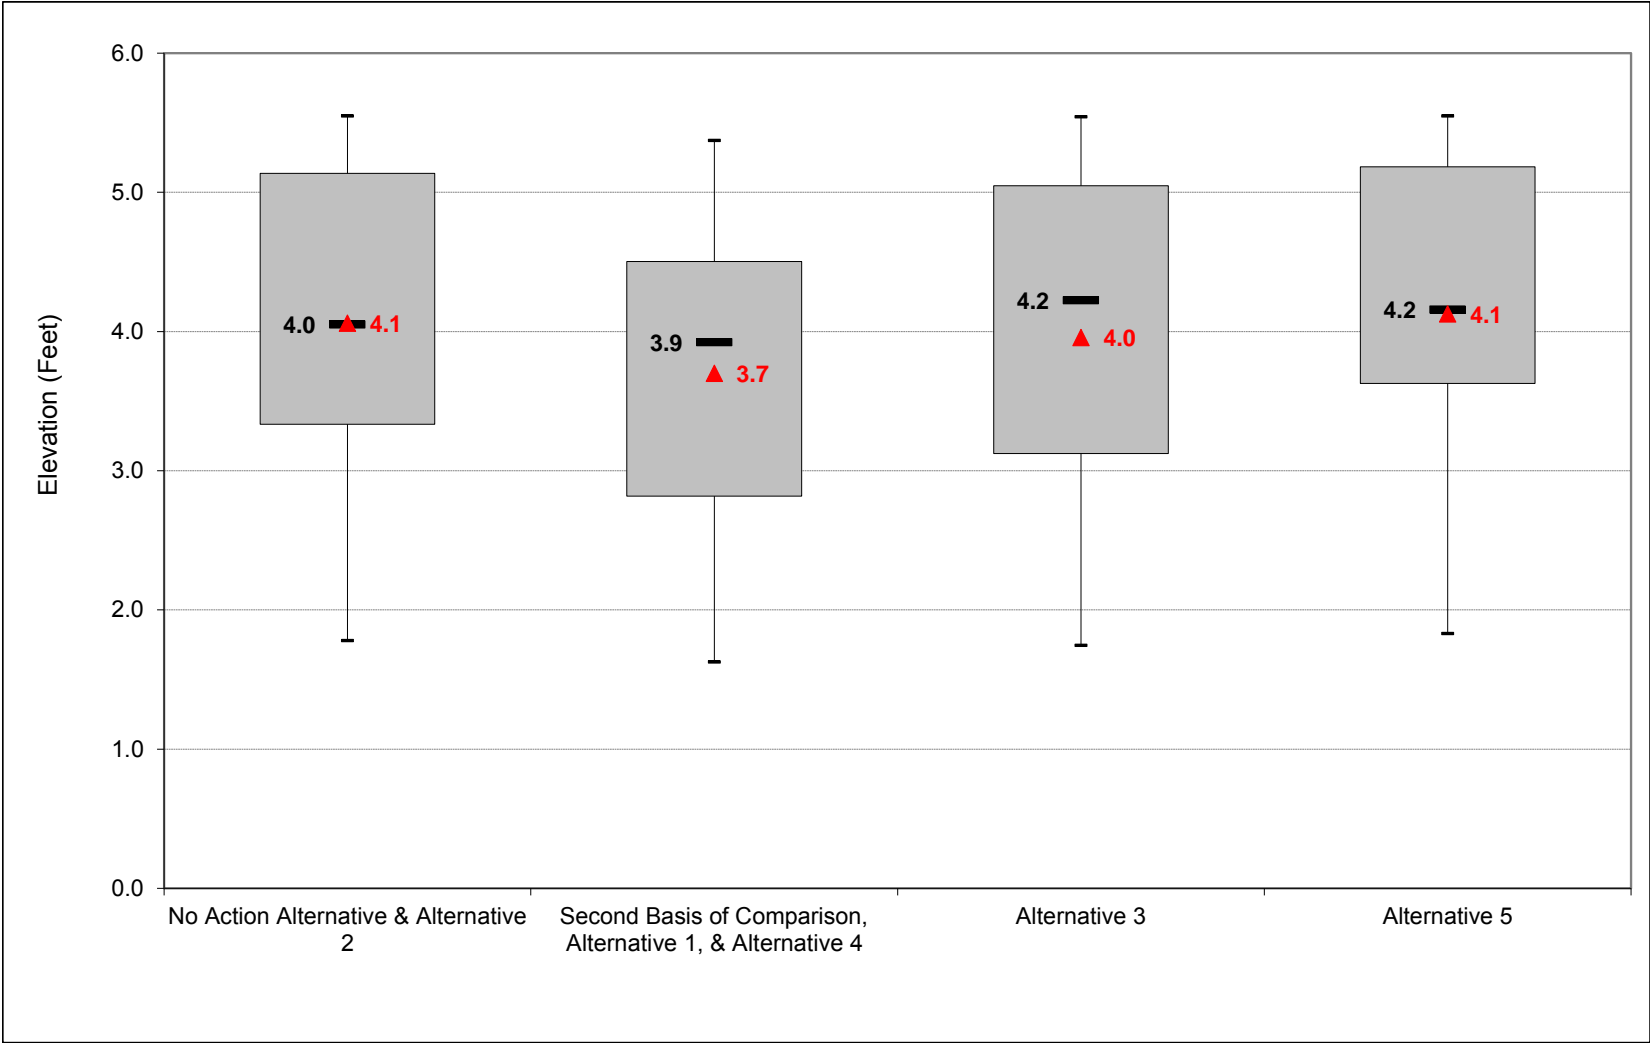

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-43-2-12. Sacramento River at Freeport, Monthly Averaged Daily Minimum Elevation, September

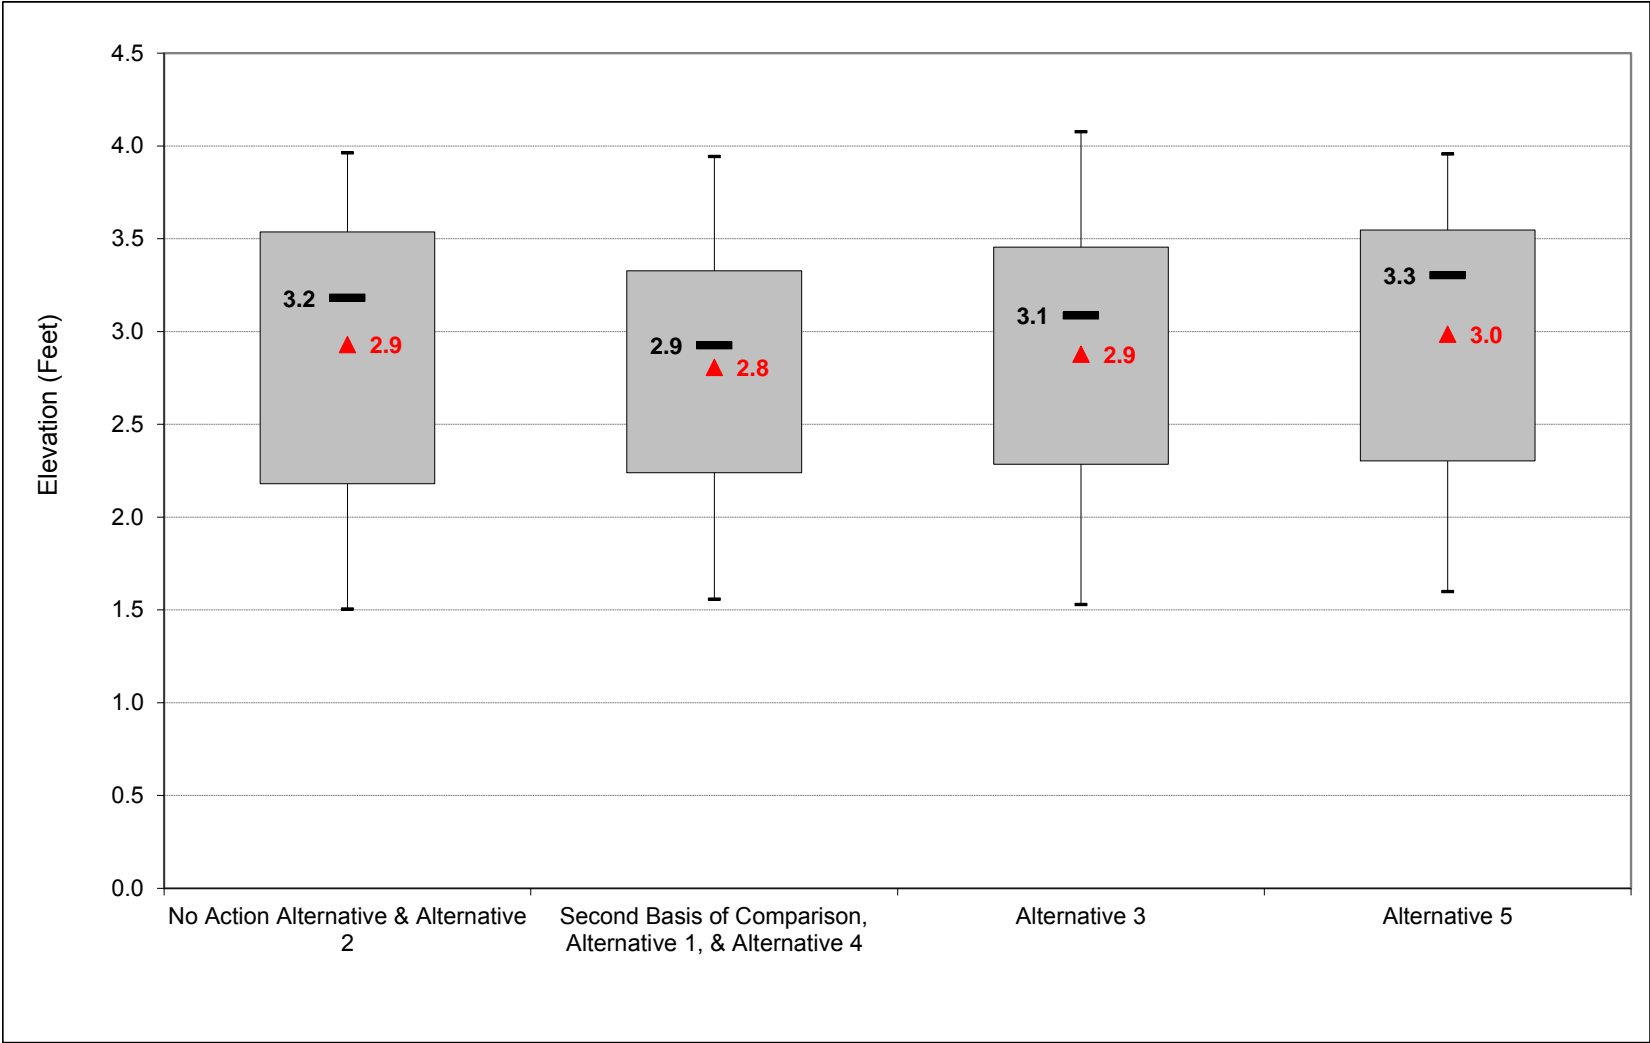

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-43-2-1. Sacramento River at Freeport, Monthly Averaged Daily Minimum Elevation

No Action Alternative												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.2	5.1	11.4	14.5	15.8	14.2	10.9	9.0	4.3	5.4	3.7	6.8
20%	3.0	4.1	7.6	12.3	14.1	11.9	7.7	5.9	3.4	5.2	3.6	6.7
30%	2.8	4.0	4.8	9.0	11.5	8.7	5.2	3.6	2.9	4.9	3.5	5.0
40%	2.5	3.6	4.0	5.7	10.0	6.8	4.4	2.9	2.7	4.5	3.4	4.7
50%	2.3	3.1	3.4	4.8	7.6	5.6	3.3	2.6	2.7	4.0	3.2	3.1
60%	1.9	2.7	3.1	4.0	5.6	4.6	2.7	2.4	2.6	3.8	2.9	2.7
70%	1.8	2.0	2.8	3.2	4.3	4.1	2.3	2.3	2.5	3.6	2.4	2.2
80%	1.6	1.8	2.2	2.9	3.5	3.1	2.2	2.1	2.2	3.1	2.0	1.9
90%	1.4	1.4	1.9	2.4	3.0	2.3	1.9	1.8	1.9	2.4	1.9	1.7
Long Term												
Full Simulation Period ^b	2.3	3.4	5.0	6.9	8.5	7.1	4.9	4.0	3.1	4.1	2.9	3.9
Water Year Types ^c												
Wet (32%)	2.8	4.5	8.3	11.2	12.9	11.0	8.0	6.9	4.4	4.4	3.4	6.5
Above Normal (16%)	2.1	3.8	5.5	8.9	10.7	9.4	5.4	3.7	2.8	5.0	3.6	4.6
Below Normal (13%)	2.5	3.4	3.4	4.1	6.9	4.1	3.0	2.7	2.6	4.8	3.3	2.6
Dry (24%)	2.1	2.6	2.9	3.8	5.3	4.8	3.2	2.5	2.6	3.6	2.3	2.2
Critical (15%)	1.7	1.7	2.4	3.1	3.5	2.7	2.1	1.7	1.9	2.3	1.9	1.7
Alternative 1												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.0	5.0	12.6	14.8	15.9	14.4	10.9	9.0	4.6	5.0	3.6	3.2
20%	2.8	3.2	8.0	13.0	14.2	12.0	7.6	6.4	4.0	4.6	3.4	3.1
30%	2.6	2.9	4.9	9.7	12.0	9.8	5.2	3.8	3.8	4.4	3.3	3.1
40%	2.3	2.7	3.9	6.1	10.7	7.0	4.4	3.2	3.5	4.1	3.1	3.0
50%	2.2	2.4	3.3	5.1	7.8	5.7	3.4	2.9	3.2	3.9	2.9	2.9
60%	2.0	2.2	3.0	3.9	5.6	4.7	2.7	2.7	3.0	3.6	2.6	2.6
70%	1.8	2.0	2.5	3.2	4.4	4.2	2.4	2.5	2.6	3.1	2.3	2.1
80%	1.7	1.7	2.1	2.8	3.6	3.2	2.3	2.2	2.5	2.7	2.1	2.0
90%	1.5	1.4	1.9	2.4	3.1	2.4	2.0	1.8	2.3	2.2	1.9	1.7
Long Term												
Full Simulation Period ^b	2.3	3.0	5.1	7.0	8.6	7.2	4.9	4.1	3.6	3.7	2.8	2.6
Water Year Types ^c												
Wet (32%)	2.7	4.0	8.8	11.5	13.0	11.1	8.0	6.9	4.6	4.1	3.2	3.2
Above Normal (16%)	2.1	3.3	5.3	9.1	10.9	9.9	5.5	4.0	3.4	4.7	3.4	3.0
Below Normal (13%)	2.5	3.0	3.3	4.3	7.2	4.3	3.1	3.1	3.7	4.4	3.0	2.6
Dry (24%)	2.1	2.2	2.8	3.8	5.4	4.8	3.2	2.6	3.0	3.1	2.3	2.2
Critical (15%)	1.8	1.7	2.4	3.1	3.4	2.7	2.1	1.7	2.2	2.1	1.9	1.7
Alternative 1 minus No Action Alternative												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.1	-0.2	1.1	0.3	0.0	0.2	0.0	0.0	0.2	-0.4	-0.1	-3.6
20%	-0.1	-1.0	0.5	0.7	0.1	0.1	0.0	0.5	0.6	-0.6	-0.1	-3.5
30%	-0.2	-1.2	0.1	0.7	0.5	1.1	0.0	0.2	0.9	-0.5	-0.2	-1.9
40%	-0.2	-0.9	0.0	0.4	0.6	0.2	0.0	0.3	0.7	-0.4	-0.3	-1.7
50%	0.0	-0.7	-0.1	0.4	0.2	0.1	0.1	0.2	0.5	-0.1	-0.3	-0.2
60%	0.1	-0.5	-0.1	0.0	0.0	0.1	0.0	0.3	0.5	-0.2	-0.4	0.0
70%	0.1	0.0	-0.4	0.0	0.1	0.1	0.0	0.2	0.2	-0.6	0.0	0.0
80%	0.1	0.0	-0.1	0.0	0.1	0.1	0.1	0.1	0.3	-0.5	0.1	0.0
90%	0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.4	-0.2	0.1	0.0
Long Term												
Full Simulation Period ^b	0.0	-0.4	0.1	0.1	0.1	0.1	0.0	0.2	0.4	-0.4	-0.1	-1.3
Water Year Types ^c												
Wet (32%)	-0.1	-0.5	0.5	0.3	0.1	0.1	0.0	0.0	0.2	-0.3	-0.2	-3.3
Above Normal (16%)	0.0	-0.5	-0.2	0.3	0.3	0.4	0.1	0.3	0.6	-0.3	-0.2	-1.6
Below Normal (13%)	0.0	-0.4	-0.1	0.2	0.4	0.2	0.1	0.5	1.1	-0.4	-0.3	0.0
Dry (24%)	0.0	-0.4	0.0	0.0	0.1	0.0	0.0	0.2	0.4	-0.5	0.0	0.0
Critical (15%)	0.1	0.0	0.0	0.0	-0.1	0.1	0.1	0.0	0.2	-0.3	0.1	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-43-2.2. Sacramento River at Freeport, Monthly Averaged Daily Minimum Elevation

No Action Alternative												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.2	5.1	11.4	14.5	15.8	14.2	10.9	9.0	4.3	5.4	3.7	6.8
20%	3.0	4.1	7.6	12.3	14.1	11.9	7.7	5.9	3.4	5.2	3.6	6.7
30%	2.8	4.0	4.8	9.0	11.5	8.7	5.2	3.6	2.9	4.9	3.5	5.0
40%	2.5	3.6	4.0	5.7	10.0	6.8	4.4	2.9	2.7	4.5	3.4	4.7
50%	2.3	3.1	3.4	4.8	7.6	5.6	3.3	2.6	2.7	4.0	3.2	3.1
60%	1.9	2.7	3.1	4.0	5.6	4.6	2.7	2.4	2.6	3.8	2.9	2.7
70%	1.8	2.0	2.8	3.2	4.3	4.1	2.3	2.3	2.5	3.6	2.4	2.2
80%	1.6	1.8	2.2	2.9	3.5	3.1	2.2	2.1	2.2	3.1	2.0	1.9
90%	1.4	1.4	1.9	2.4	3.0	2.3	1.9	1.8	1.9	2.4	1.9	1.7
Long Term												
Full Simulation Period ^b	2.3	3.4	5.0	6.9	8.5	7.1	4.9	4.0	3.1	4.1	2.9	3.9
Water Year Types ^c												
Wet (32%)	2.8	4.5	8.3	11.2	12.9	11.0	8.0	6.9	4.4	4.4	3.4	6.5
Above Normal (16%)	2.1	3.8	5.5	8.9	10.7	9.4	5.4	3.7	2.8	5.0	3.6	4.6
Below Normal (13%)	2.5	3.4	3.4	4.1	6.9	4.1	3.0	2.7	2.6	4.8	3.3	2.6
Dry (24%)	2.1	2.6	2.9	3.8	5.3	4.8	3.2	2.5	2.6	3.6	2.3	2.2
Critical (15%)	1.7	1.7	2.4	3.1	3.5	2.7	2.1	1.7	1.9	2.3	1.9	1.7

Alternative 3												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.1	5.0	12.6	14.7	15.9	14.5	10.9	9.0	4.3	5.3	3.7	3.3
20%	2.8	3.2	8.2	12.9	14.2	12.0	7.6	6.1	3.9	5.1	3.5	3.2
30%	2.6	2.9	5.0	9.7	12.0	9.3	5.2	3.8	3.5	5.0	3.3	3.0
40%	2.4	2.7	4.0	6.1	10.6	7.0	4.4	3.2	3.3	4.5	3.2	2.9
50%	2.2	2.4	3.2	4.9	7.7	5.7	3.4	2.9	3.1	4.2	3.1	2.8
60%	1.9	2.2	3.0	3.9	5.6	4.7	2.7	2.6	3.0	3.8	2.9	2.7
70%	1.8	2.0	2.7	3.1	4.6	4.2	2.4	2.4	2.8	3.2	2.4	2.2
80%	1.6	1.7	2.2	2.8	3.5	3.2	2.3	2.3	2.6	2.8	2.1	1.9
90%	1.4	1.4	1.8	2.3	3.1	2.3	2.0	1.8	2.3	2.2	1.8	1.6
Long Term												
Full Simulation Period ^b	2.3	3.0	5.1	7.0	8.6	7.2	4.9	4.1	3.5	4.0	2.9	2.6
Water Year Types ^c												
Wet (32%)	2.7	4.0	8.8	11.5	13.0	11.0	8.0	6.9	4.7	4.3	3.2	3.2
Above Normal (16%)	2.1	3.4	5.3	9.0	10.9	9.8	5.5	4.0	3.3	4.9	3.5	3.0
Below Normal (13%)	2.4	2.9	3.4	4.3	7.2	4.3	3.1	3.0	3.2	4.9	3.4	2.8
Dry (24%)	2.1	2.2	2.8	3.7	5.4	4.8	3.2	2.6	3.1	3.5	2.3	2.2
Critical (15%)	1.8	1.6	2.3	3.0	3.5	2.7	2.1	1.7	2.2	2.1	1.9	1.7

Alternative 3 minus No Action Alternative												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.1	-0.1	1.1	0.2	0.0	0.3	0.0	0.0	-0.1	-0.1	0.0	-3.5
20%	-0.1	-1.0	0.6	0.6	0.1	0.1	0.0	0.2	0.5	-0.1	-0.1	-3.5
30%	-0.2	-1.1	0.2	0.7	0.5	0.6	0.0	0.2	0.6	0.1	-0.1	-1.9
40%	-0.2	-0.9	0.0	0.4	0.5	0.2	0.0	0.3	0.6	0.0	-0.1	-1.7
50%	-0.1	-0.7	-0.1	0.1	0.2	0.1	0.1	0.2	0.5	0.2	-0.1	-0.2
60%	0.0	-0.5	-0.2	0.0	0.1	0.1	0.0	0.2	0.5	0.0	-0.1	0.0
70%	0.0	0.0	-0.1	-0.1	0.3	0.1	0.1	0.2	0.3	-0.4	0.1	0.0
80%	0.0	0.0	-0.1	-0.1	0.0	0.1	0.1	0.1	0.4	-0.4	0.1	0.0
90%	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.3	-0.2	0.0	-0.1
Long Term												
Full Simulation Period ^b	-0.1	-0.4	0.1	0.1	0.1	0.1	0.0	0.2	0.4	-0.1	-0.1	-1.3
Water Year Types ^c												
Wet (32%)	-0.2	-0.5	0.5	0.3	0.1	0.1	0.0	0.1	0.3	-0.1	-0.2	-3.4
Above Normal (16%)	-0.1	-0.5	-0.2	0.1	0.2	0.3	0.0	0.3	0.5	-0.1	-0.1	-1.6
Below Normal (13%)	-0.1	-0.5	-0.1	0.2	0.4	0.2	0.1	0.3	0.5	0.1	0.1	0.2
Dry (24%)	0.0	-0.5	-0.1	0.0	0.1	0.0	0.0	0.2	0.4	-0.1	0.0	0.0
Critical (15%)	0.0	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.2	-0.2	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-43-2.3. Sacramento River at Freeport, Monthly Averaged Daily Minimum Elevation

No Action Alternative

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.2	5.1	11.4	14.5	15.8	14.2	10.9	9.0	4.3	5.4	3.7	6.8
20%	3.0	4.1	7.6	12.3	14.1	11.9	7.7	5.9	3.4	5.2	3.6	6.7
30%	2.8	4.0	4.8	9.0	11.5	8.7	5.2	3.6	2.9	4.9	3.5	5.0
40%	2.5	3.6	4.0	5.7	10.0	6.8	4.4	2.9	2.7	4.5	3.4	4.7
50%	2.3	3.1	3.4	4.8	7.6	5.6	3.3	2.6	2.7	4.0	3.2	3.1
60%	1.9	2.7	3.1	4.0	5.6	4.6	2.7	2.4	2.6	3.8	2.9	2.7
70%	1.8	2.0	2.8	3.2	4.3	4.1	2.3	2.3	2.5	3.6	2.4	2.2
80%	1.6	1.8	2.2	2.9	3.5	3.1	2.2	2.1	2.2	3.1	2.0	1.9
90%	1.4	1.4	1.9	2.4	3.0	2.3	1.9	1.8	1.9	2.4	1.9	1.7
Long Term												
Full Simulation Period ^b	2.3	3.4	5.0	6.9	8.5	7.1	4.9	4.0	3.1	4.1	2.9	3.9
Water Year Types ^c												
Wet (32%)	2.8	4.5	8.3	11.2	12.9	11.0	8.0	6.9	4.4	4.4	3.4	6.5
Above Normal (16%)	2.1	3.8	5.5	8.9	10.7	9.4	5.4	3.7	2.8	5.0	3.6	4.6
Below Normal (13%)	2.5	3.4	3.4	4.1	6.9	4.1	3.0	2.7	2.6	4.8	3.3	2.6
Dry (24%)	2.1	2.6	2.9	3.8	5.3	4.8	3.2	2.5	2.6	3.6	2.3	2.2
Critical (15%)	1.7	1.7	2.4	3.1	3.5	2.7	2.1	1.7	1.9	2.3	1.9	1.7

Alternative 5

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.2	5.1	11.4	14.5	15.8	14.2	10.9	9.0	4.4	5.4	3.7	6.8
20%	2.9	4.2	7.6	12.3	14.1	11.9	7.7	5.9	3.3	5.2	3.6	6.6
30%	2.8	4.1	4.8	9.0	11.5	8.7	5.2	3.6	2.9	5.0	3.5	5.0
40%	2.5	3.6	3.9	5.7	10.0	6.8	4.4	2.7	2.7	4.6	3.4	4.6
50%	2.3	3.1	3.4	4.8	7.6	5.6	3.3	2.5	2.7	4.2	3.3	3.2
60%	1.9	2.7	3.1	4.0	5.6	4.6	2.6	2.3	2.6	3.9	3.1	2.8
70%	1.7	2.0	2.8	3.2	4.3	4.1	2.4	2.1	2.5	3.7	2.4	2.2
80%	1.6	1.8	2.2	2.9	3.5	3.1	2.1	1.9	2.1	3.4	2.1	1.9
90%	1.4	1.4	1.8	2.4	3.0	2.3	1.9	1.6	1.9	2.5	2.0	1.7
Long Term												
Full Simulation Period ^b	2.3	3.4	5.0	6.9	8.5	7.1	4.9	3.9	3.1	4.1	3.0	3.9
Water Year Types ^c												
Wet (32%)	2.8	4.6	8.3	11.2	12.9	11.0	8.0	6.9	4.4	4.5	3.5	6.5
Above Normal (16%)	2.2	3.8	5.5	8.9	10.7	9.4	5.4	3.7	2.8	5.0	3.6	4.6
Below Normal (13%)	2.5	3.4	3.4	4.1	6.9	4.1	3.0	2.6	2.6	4.8	3.4	2.7
Dry (24%)	2.1	2.6	2.9	3.8	5.3	4.8	3.2	2.3	2.6	3.7	2.4	2.2
Critical (15%)	1.7	1.7	2.4	3.1	3.5	2.7	2.0	1.6	2.0	2.4	2.0	1.7

Alternative 5 minus No Action Alternative

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
30%	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-0.1	0.0	0.1	0.1	0.1
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.1	0.2	0.1
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.2	0.0	0.1	0.1	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.2	-0.1	0.2	0.1	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.2	0.0	0.1	0.1	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.1	0.1	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.1
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.2	0.0	0.1	0.1	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.0	0.1	0.1	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-43-2-4. Sacramento River at Freeport, Monthly Averaged Daily Minimum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.0	5.0	12.6	14.8	15.9	14.4	10.9	9.0	4.6	5.0	3.6	3.2
20%	2.8	3.2	8.0	13.0	14.2	12.0	7.6	6.4	4.0	4.6	3.4	3.1
30%	2.6	2.9	4.9	9.7	12.0	9.8	5.2	3.8	3.8	4.4	3.3	3.1
40%	2.3	2.7	3.9	6.1	10.7	7.0	4.4	3.2	3.5	4.1	3.1	3.0
50%	2.2	2.4	3.3	5.1	7.8	5.7	3.4	2.9	3.2	3.9	2.9	2.9
60%	2.0	2.2	3.0	3.9	5.6	4.7	2.7	2.7	3.0	3.6	2.6	2.6
70%	1.8	2.0	2.5	3.2	4.4	4.2	2.4	2.5	2.6	3.1	2.3	2.1
80%	1.7	1.7	2.1	2.8	3.6	3.2	2.3	2.2	2.5	2.7	2.1	2.0
90%	1.5	1.4	1.9	2.4	3.1	2.4	2.0	1.8	2.3	2.2	1.9	1.7
Long Term												
Full Simulation Period ^b	2.3	3.0	5.1	7.0	8.6	7.2	4.9	4.1	3.6	3.7	2.8	2.6
Water Year Types ^c												
Wet (32%)	2.7	4.0	8.8	11.5	13.0	11.1	8.0	6.9	4.6	4.1	3.2	3.2
Above Normal (16%)	2.1	3.3	5.3	9.1	10.9	9.9	5.5	4.0	3.4	4.7	3.4	3.0
Below Normal (13%)	2.5	3.0	3.3	4.3	7.2	4.3	3.1	3.1	3.7	4.4	3.0	2.6
Dry (24%)	2.1	2.2	2.8	3.8	5.4	4.8	3.2	2.6	3.0	3.1	2.3	2.2
Critical (15%)	1.8	1.7	2.4	3.1	3.4	2.7	2.1	1.7	2.2	2.1	1.9	1.7

No Action Alternative

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.2	5.1	11.4	14.5	15.8	14.2	10.9	9.0	4.3	5.4	3.7	6.8
20%	3.0	4.1	7.6	12.3	14.1	11.9	7.7	5.9	3.4	5.2	3.6	6.7
30%	2.8	4.0	4.8	9.0	11.5	8.7	5.2	3.6	2.9	4.9	3.5	5.0
40%	2.5	3.6	4.0	5.7	10.0	6.8	4.4	2.9	2.7	4.5	3.4	4.7
50%	2.3	3.1	3.4	4.8	7.6	5.6	3.3	2.6	2.7	4.0	3.2	3.1
60%	1.9	2.7	3.1	4.0	5.6	4.6	2.7	2.4	2.6	3.8	2.9	2.7
70%	1.8	2.0	2.8	3.2	4.3	4.1	2.3	2.3	2.5	3.6	2.4	2.2
80%	1.6	1.8	2.2	2.9	3.5	3.1	2.2	2.1	2.2	3.1	2.0	1.9
90%	1.4	1.4	1.9	2.4	3.0	2.3	1.9	1.8	1.9	2.4	1.9	1.7
Long Term												
Full Simulation Period ^b	2.3	3.4	5.0	6.9	8.5	7.1	4.9	4.0	3.1	4.1	2.9	3.9
Water Year Types ^c												
Wet (32%)	2.8	4.5	8.3	11.2	12.9	11.0	8.0	6.9	4.4	4.4	3.4	6.5
Above Normal (16%)	2.1	3.8	5.5	8.9	10.7	9.4	5.4	3.7	2.8	5.0	3.6	4.6
Below Normal (13%)	2.5	3.4	3.4	4.1	6.9	4.1	3.0	2.7	2.6	4.8	3.3	2.6
Dry (24%)	2.1	2.6	2.9	3.8	5.3	4.8	3.2	2.5	2.6	3.6	2.3	2.2
Critical (15%)	1.7	1.7	2.4	3.1	3.5	2.7	2.1	1.7	1.9	2.3	1.9	1.7

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.1	0.2	-1.1	-0.3	0.0	-0.2	0.0	0.0	-0.2	0.4	0.1	3.6
20%	0.1	1.0	-0.5	-0.7	-0.1	-0.1	0.0	-0.5	-0.6	0.6	0.1	3.5
30%	0.2	1.2	-0.1	-0.7	-0.5	-1.1	0.0	-0.2	-0.9	0.5	0.2	1.9
40%	0.2	0.9	0.0	-0.4	-0.6	-0.2	0.0	-0.3	-0.7	0.4	0.3	1.7
50%	0.0	0.7	0.1	-0.4	-0.2	-0.1	-0.1	-0.2	-0.5	0.1	0.3	0.2
60%	-0.1	0.5	0.1	0.0	0.0	-0.1	0.0	-0.3	-0.5	0.2	0.4	0.0
70%	-0.1	0.0	0.4	0.0	-0.1	-0.1	0.0	-0.2	-0.2	0.6	0.0	0.0
80%	-0.1	0.0	0.1	0.0	-0.1	-0.1	-0.1	-0.1	-0.3	0.5	-0.1	0.0
90%	-0.1	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	-0.4	0.2	-0.1	0.0
Long Term												
Full Simulation Period ^b	0.0	0.4	-0.1	-0.1	-0.1	-0.1	0.0	-0.2	-0.4	0.4	0.1	1.3
Water Year Types ^c												
Wet (32%)	0.1	0.5	-0.5	-0.3	-0.1	-0.1	0.0	0.0	-0.2	0.3	0.2	3.3
Above Normal (16%)	0.0	0.5	0.2	-0.3	-0.3	-0.4	-0.1	-0.3	-0.6	0.3	0.2	1.6
Below Normal (13%)	0.0	0.4	0.1	-0.2	-0.4	-0.2	-0.1	-0.5	-1.1	0.4	0.3	0.0
Dry (24%)	0.0	0.4	0.0	0.0	-0.1	0.0	0.0	-0.2	-0.4	0.5	0.0	0.0
Critical (15%)	-0.1	0.0	0.0	0.0	0.1	-0.1	-0.1	0.0	-0.2	0.3	-0.1	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-43-2.5. Sacramento River at Freeport, Monthly Averaged Daily Minimum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.0	5.0	12.6	14.8	15.9	14.4	10.9	9.0	4.6	5.0	3.6	3.2
20%	2.8	3.2	8.0	13.0	14.2	12.0	7.6	6.4	4.0	4.6	3.4	3.1
30%	2.6	2.9	4.9	9.7	12.0	9.8	5.2	3.8	3.8	4.4	3.3	3.1
40%	2.3	2.7	3.9	6.1	10.7	7.0	4.4	3.2	3.5	4.1	3.1	3.0
50%	2.2	2.4	3.3	5.1	7.8	5.7	3.4	2.9	3.2	3.9	2.9	2.9
60%	2.0	2.2	3.0	3.9	5.6	4.7	2.7	2.7	3.0	3.6	2.6	2.6
70%	1.8	2.0	2.5	3.2	4.4	4.2	2.4	2.5	2.6	3.1	2.3	2.1
80%	1.7	1.7	2.1	2.8	3.6	3.2	2.3	2.2	2.5	2.7	2.1	2.0
90%	1.5	1.4	1.9	2.4	3.1	2.4	2.0	1.8	2.3	2.2	1.9	1.7
Long Term												
Full Simulation Period ^b	2.3	3.0	5.1	7.0	8.6	7.2	4.9	4.1	3.6	3.7	2.8	2.6
Water Year Types ^c												
Wet (32%)	2.7	4.0	8.8	11.5	13.0	11.1	8.0	6.9	4.6	4.1	3.2	3.2
Above Normal (16%)	2.1	3.3	5.3	9.1	10.9	9.9	5.5	4.0	3.4	4.7	3.4	3.0
Below Normal (13%)	2.5	3.0	3.3	4.3	7.2	4.3	3.1	3.1	3.7	4.4	3.0	2.6
Dry (24%)	2.1	2.2	2.8	3.8	5.4	4.8	3.2	2.6	3.0	3.1	2.3	2.2
Critical (15%)	1.8	1.7	2.4	3.1	3.4	2.7	2.1	1.7	2.2	2.1	1.9	1.7

Alternative 3

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.1	5.0	12.6	14.7	15.9	14.5	10.9	9.0	4.3	5.3	3.7	3.3
20%	2.8	3.2	8.2	12.9	14.2	12.0	7.6	6.1	3.9	5.1	3.5	3.2
30%	2.6	2.9	5.0	9.7	12.0	9.3	5.2	3.8	3.5	5.0	3.3	3.0
40%	2.4	2.7	4.0	6.1	10.6	7.0	4.4	3.2	3.3	4.5	3.2	2.9
50%	2.2	2.4	3.2	4.9	7.7	5.7	3.4	2.9	3.1	4.2	3.1	2.8
60%	1.9	2.2	3.0	3.9	5.6	4.7	2.7	2.6	3.0	3.8	2.9	2.7
70%	1.8	2.0	2.7	3.1	4.6	4.2	2.4	2.4	2.8	3.2	2.4	2.2
80%	1.6	1.7	2.2	2.8	3.5	3.2	2.3	2.3	2.6	2.8	2.1	1.9
90%	1.4	1.4	1.8	2.3	3.1	2.3	2.0	1.8	2.3	2.2	1.8	1.6
Long Term												
Full Simulation Period ^b	2.3	3.0	5.1	7.0	8.6	7.2	4.9	4.1	3.5	4.0	2.9	2.6
Water Year Types ^c												
Wet (32%)	2.7	4.0	8.8	11.5	13.0	11.0	8.0	6.9	4.7	4.3	3.2	3.2
Above Normal (16%)	2.1	3.4	5.3	9.0	10.9	9.8	5.5	4.0	3.3	4.9	3.5	3.0
Below Normal (13%)	2.4	2.9	3.4	4.3	7.2	4.3	3.1	3.0	3.2	4.9	3.4	2.8
Dry (24%)	2.1	2.2	2.8	3.7	5.4	4.8	3.2	2.6	3.1	3.5	2.3	2.2
Critical (15%)	1.8	1.6	2.3	3.0	3.5	2.7	2.1	1.7	2.2	2.1	1.9	1.7

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.1	0.0	-0.1	0.0	0.1	0.0	0.0	-0.3	0.3	0.1	0.1
20%	0.0	0.0	0.2	-0.1	0.0	0.0	0.0	-0.3	-0.1	0.5	0.1	0.0
30%	0.0	0.0	0.1	0.0	0.0	-0.5	0.0	0.0	-0.3	0.6	0.1	0.0
40%	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	-0.1	0.4	0.1	0.0
50%	0.0	0.0	-0.1	-0.2	0.0	0.0	0.0	0.0	0.0	0.3	0.2	0.0
60%	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.2	0.3	0.1
70%	-0.1	-0.1	0.2	-0.1	0.1	0.0	0.0	-0.1	0.2	0.2	0.1	0.0
80%	-0.1	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.1	0.1	0.0	0.0
90%	-0.1	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	-0.1	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3	0.1	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.2	0.0	0.0
Above Normal (16%)	0.0	0.1	0.1	-0.1	0.0	-0.1	0.0	0.0	-0.1	0.2	0.1	0.0
Below Normal (13%)	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.6	0.5	0.5	0.2
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.4	0.0	0.0
Critical (15%)	-0.1	-0.1	-0.1	-0.1	0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-43-2.6. Sacramento River at Freeport, Monthly Averaged Daily Minimum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.0	5.0	12.6	14.8	15.9	14.4	10.9	9.0	4.6	5.0	3.6	3.2
20%	2.8	3.2	8.0	13.0	14.2	12.0	7.6	6.4	4.0	4.6	3.4	3.1
30%	2.6	2.9	4.9	9.7	12.0	9.8	5.2	3.8	3.8	4.4	3.3	3.1
40%	2.3	2.7	3.9	6.1	10.7	7.0	4.4	3.2	3.5	4.1	3.1	3.0
50%	2.2	2.4	3.3	5.1	7.8	5.7	3.4	2.9	3.2	3.9	2.9	2.9
60%	2.0	2.2	3.0	3.9	5.6	4.7	2.7	2.7	3.0	3.6	2.6	2.6
70%	1.8	2.0	2.5	3.2	4.4	4.2	2.4	2.5	2.6	3.1	2.3	2.1
80%	1.7	1.7	2.1	2.8	3.6	3.2	2.3	2.2	2.5	2.7	2.1	2.0
90%	1.5	1.4	1.9	2.4	3.1	2.4	2.0	1.8	2.3	2.2	1.9	1.7
Long Term												
Full Simulation Period ^b	2.3	3.0	5.1	7.0	8.6	7.2	4.9	4.1	3.6	3.7	2.8	2.6
Water Year Types ^c												
Wet (32%)	2.7	4.0	8.8	11.5	13.0	11.1	8.0	6.9	4.6	4.1	3.2	3.2
Above Normal (16%)	2.1	3.3	5.3	9.1	10.9	9.9	5.5	4.0	3.4	4.7	3.4	3.0
Below Normal (13%)	2.5	3.0	3.3	4.3	7.2	4.3	3.1	3.1	3.7	4.4	3.0	2.6
Dry (24%)	2.1	2.2	2.8	3.8	5.4	4.8	3.2	2.6	3.0	3.1	2.3	2.2
Critical (15%)	1.8	1.7	2.4	3.1	3.4	2.7	2.1	1.7	2.2	2.1	1.9	1.7

Alternative 5

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.2	5.1	11.4	14.5	15.8	14.2	10.9	9.0	4.4	5.4	3.7	6.8
20%	2.9	4.2	7.6	12.3	14.1	11.9	7.7	5.9	3.3	5.2	3.6	6.6
30%	2.8	4.1	4.8	9.0	11.5	8.7	5.2	3.6	2.9	5.0	3.5	5.0
40%	2.5	3.6	3.9	5.7	10.0	6.8	4.4	2.7	2.7	4.6	3.4	4.6
50%	2.3	3.1	3.4	4.8	7.6	5.6	3.3	2.5	2.7	4.2	3.3	3.2
60%	1.9	2.7	3.1	4.0	5.6	4.6	2.6	2.3	2.6	3.9	3.1	2.8
70%	1.7	2.0	2.8	3.2	4.3	4.1	2.4	2.1	2.5	3.7	2.4	2.2
80%	1.6	1.8	2.2	2.9	3.5	3.1	2.1	1.9	2.1	3.4	2.1	1.9
90%	1.4	1.4	1.8	2.4	3.0	2.3	1.9	1.6	1.9	2.5	2.0	1.7
Long Term												
Full Simulation Period ^b	2.3	3.4	5.0	6.9	8.5	7.1	4.9	3.9	3.1	4.1	3.0	3.9
Water Year Types ^c												
Wet (32%)	2.8	4.6	8.3	11.2	12.9	11.0	8.0	6.9	4.4	4.5	3.5	6.5
Above Normal (16%)	2.2	3.8	5.5	8.9	10.7	9.4	5.4	3.7	2.8	5.0	3.6	4.6
Below Normal (13%)	2.5	3.4	3.4	4.1	6.9	4.1	3.0	2.6	2.6	4.8	3.4	2.7
Dry (24%)	2.1	2.6	2.9	3.8	5.3	4.8	3.2	2.3	2.6	3.7	2.4	2.2
Critical (15%)	1.7	1.7	2.4	3.1	3.5	2.7	2.0	1.6	2.0	2.4	2.0	1.7

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.1	0.2	-1.1	-0.3	0.0	-0.2	0.0	0.0	-0.2	0.4	0.1	3.6
20%	0.1	1.0	-0.5	-0.7	-0.1	-0.1	0.0	-0.6	-0.6	0.6	0.1	3.5
30%	0.1	1.2	-0.1	-0.7	-0.4	-1.1	0.0	-0.2	-0.9	0.6	0.2	1.9
40%	0.2	0.9	0.0	-0.4	-0.6	-0.2	0.0	-0.4	-0.7	0.4	0.3	1.7
50%	0.1	0.7	0.1	-0.3	-0.1	-0.1	-0.1	-0.4	-0.5	0.2	0.4	0.3
60%	-0.1	0.5	0.1	0.0	0.0	-0.1	0.0	-0.4	-0.5	0.3	0.5	0.2
70%	-0.1	0.0	0.4	0.0	-0.1	-0.1	0.0	-0.4	-0.2	0.7	0.1	0.0
80%	-0.1	0.0	0.1	0.0	-0.1	-0.1	-0.2	-0.4	-0.4	0.7	0.0	0.0
90%	-0.1	0.0	-0.1	0.0	0.0	-0.1	-0.1	-0.2	-0.4	0.3	0.0	0.1
Long Term												
Full Simulation Period ^b	0.0	0.4	-0.1	-0.1	-0.1	-0.1	-0.1	-0.2	-0.4	0.4	0.2	1.3
Water Year Types ^c												
Wet (32%)	0.1	0.6	-0.5	-0.2	-0.1	-0.1	0.0	0.0	-0.2	0.4	0.2	3.3
Above Normal (16%)	0.1	0.5	0.2	-0.3	-0.3	-0.4	-0.1	-0.3	-0.7	0.3	0.2	1.6
Below Normal (13%)	0.0	0.4	0.1	-0.2	-0.4	-0.2	-0.1	-0.6	-1.1	0.4	0.4	0.1
Dry (24%)	0.0	0.4	0.0	0.0	-0.1	0.0	0.0	-0.4	-0.4	0.6	0.1	0.0
Critical (15%)	-0.1	0.0	0.0	0.0	0.1	-0.1	-0.1	-0.1	-0.2	0.3	0.1	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 **C.44. Sacramento River downstream of Delta Cross Channel**
2 **Water Surface Elevation**

Figure C-44-1-1. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Maximum Elevation, October

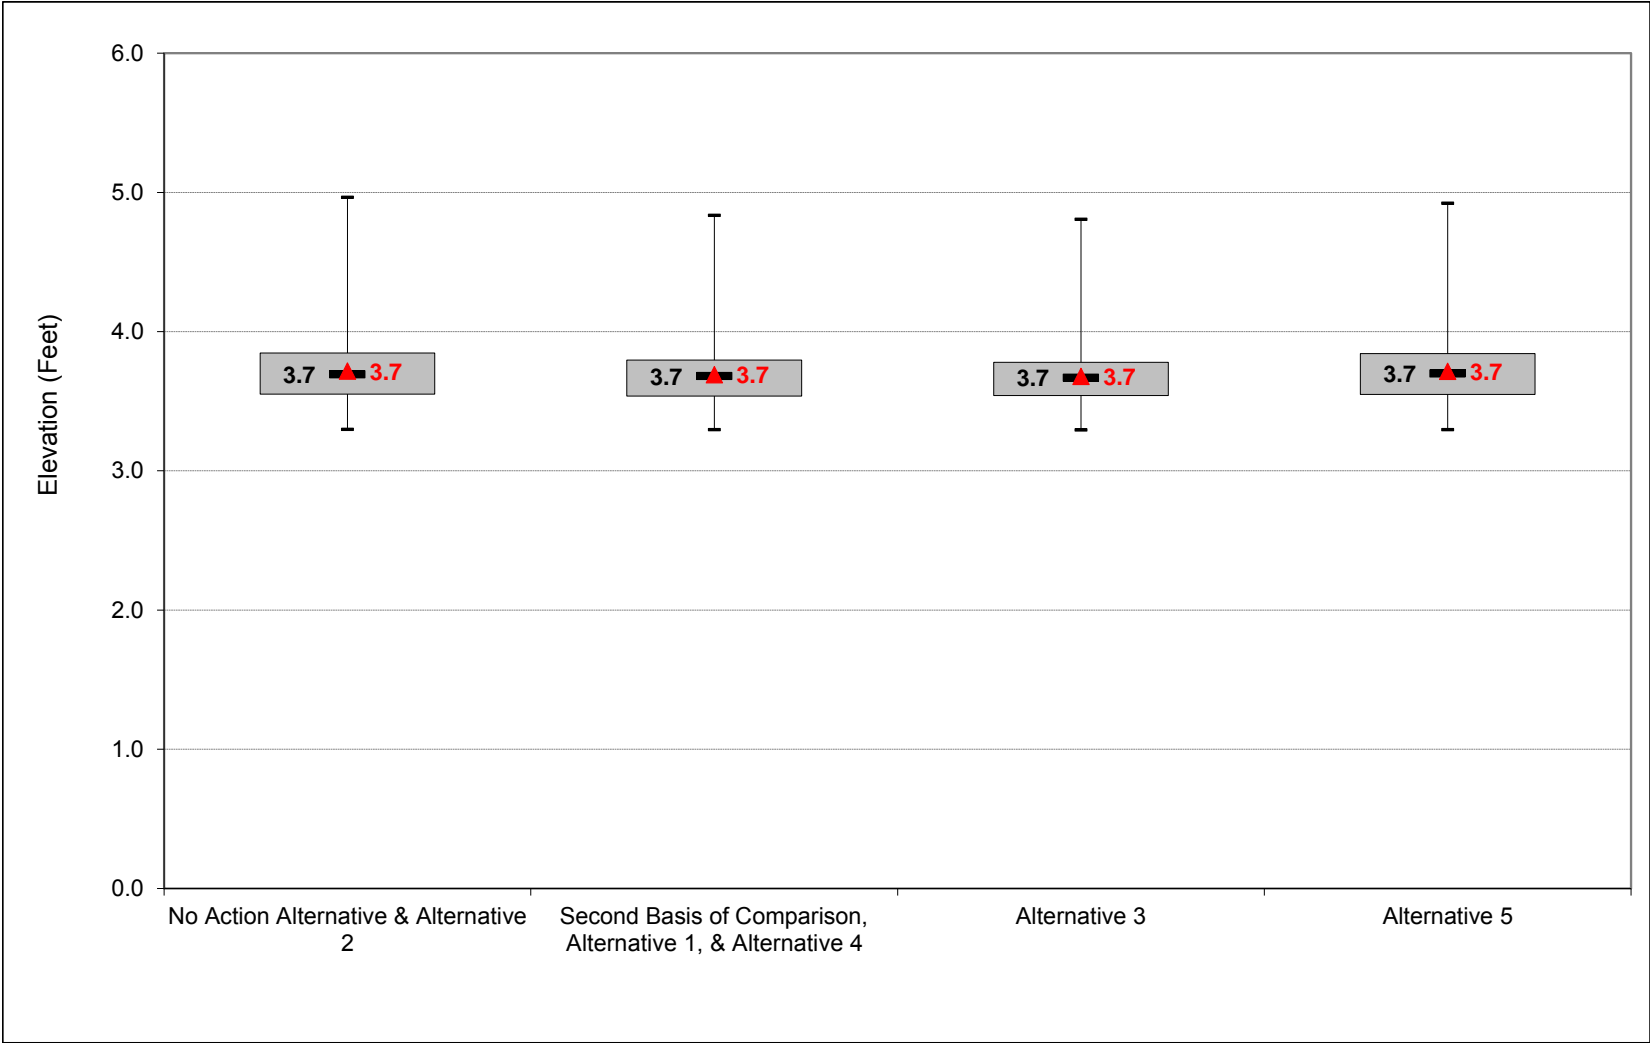


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-44-1-2. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Maximum Elevation, November

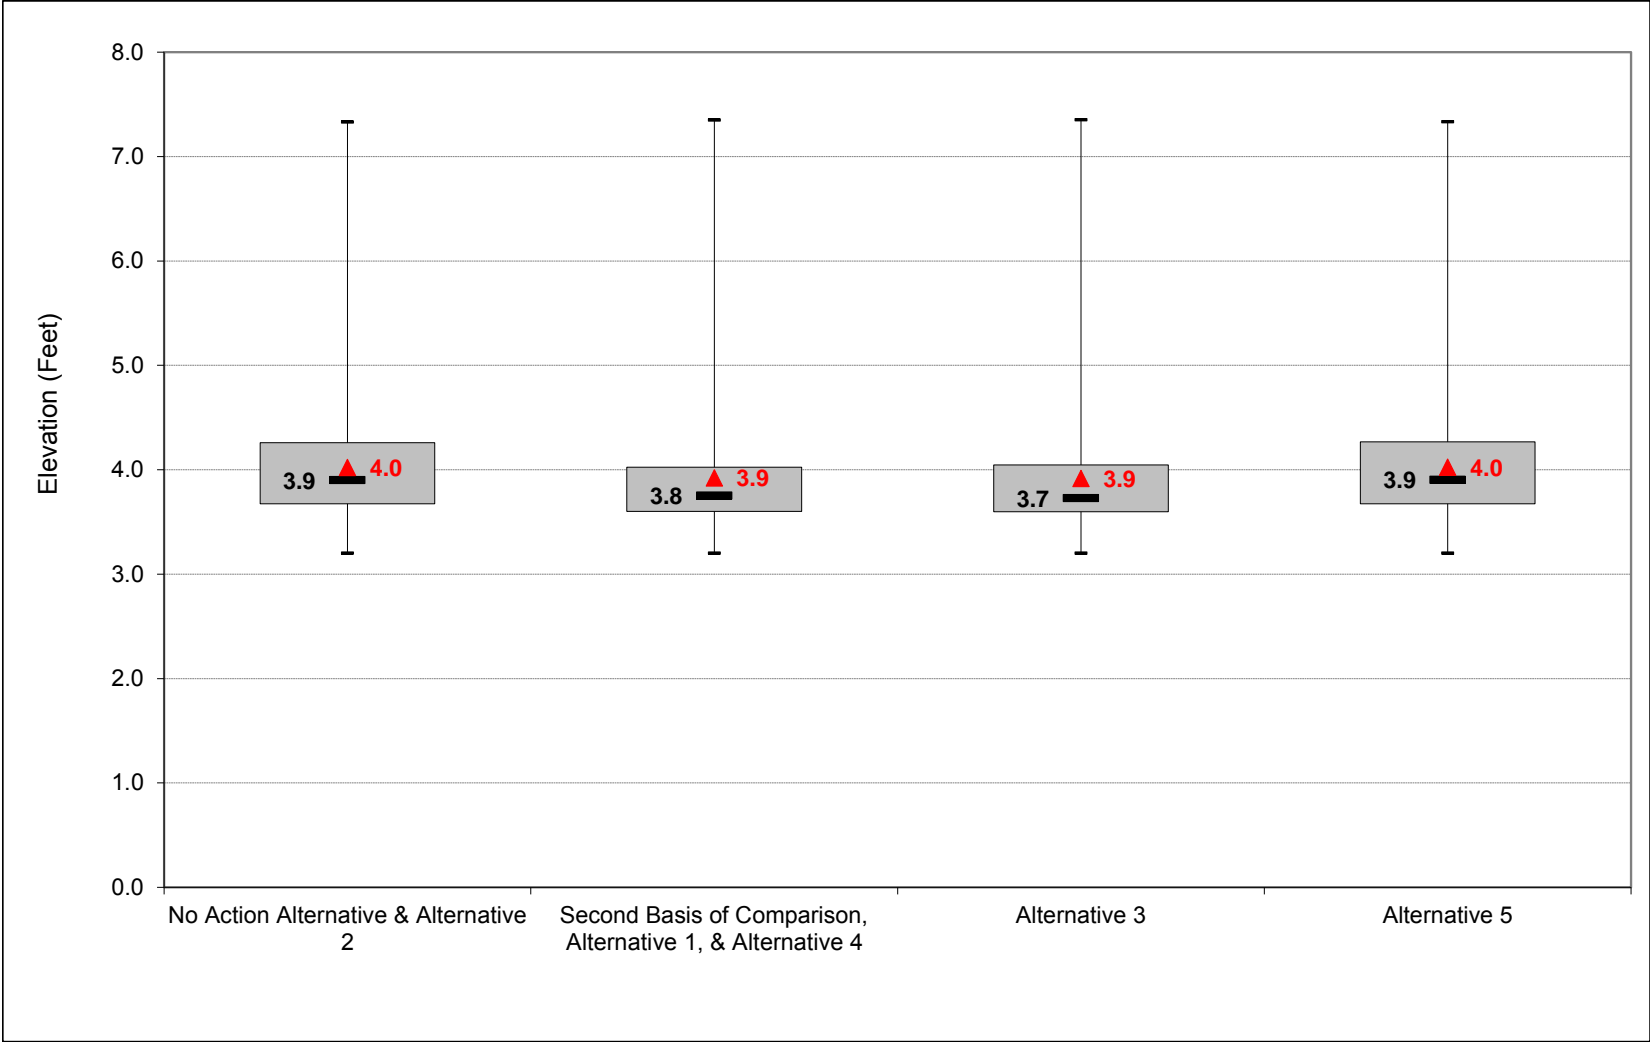


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-44-1-3. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Maximum Elevation, December

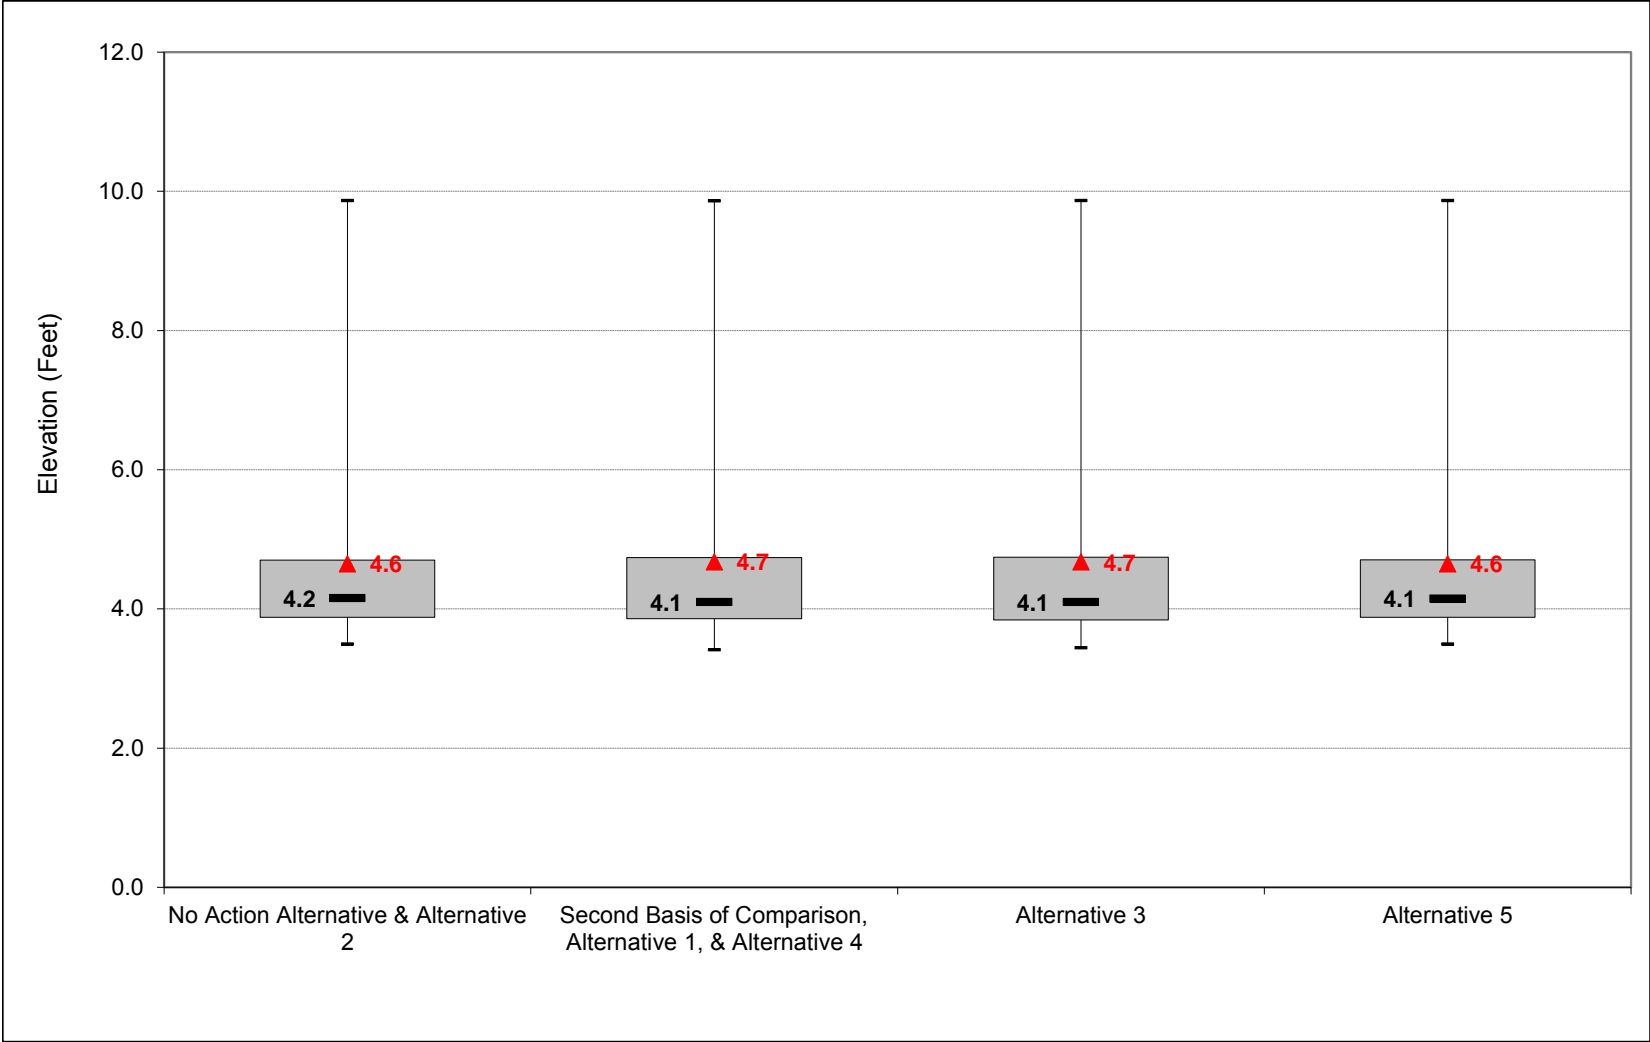


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-44-1-4. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Maximum Elevation, January

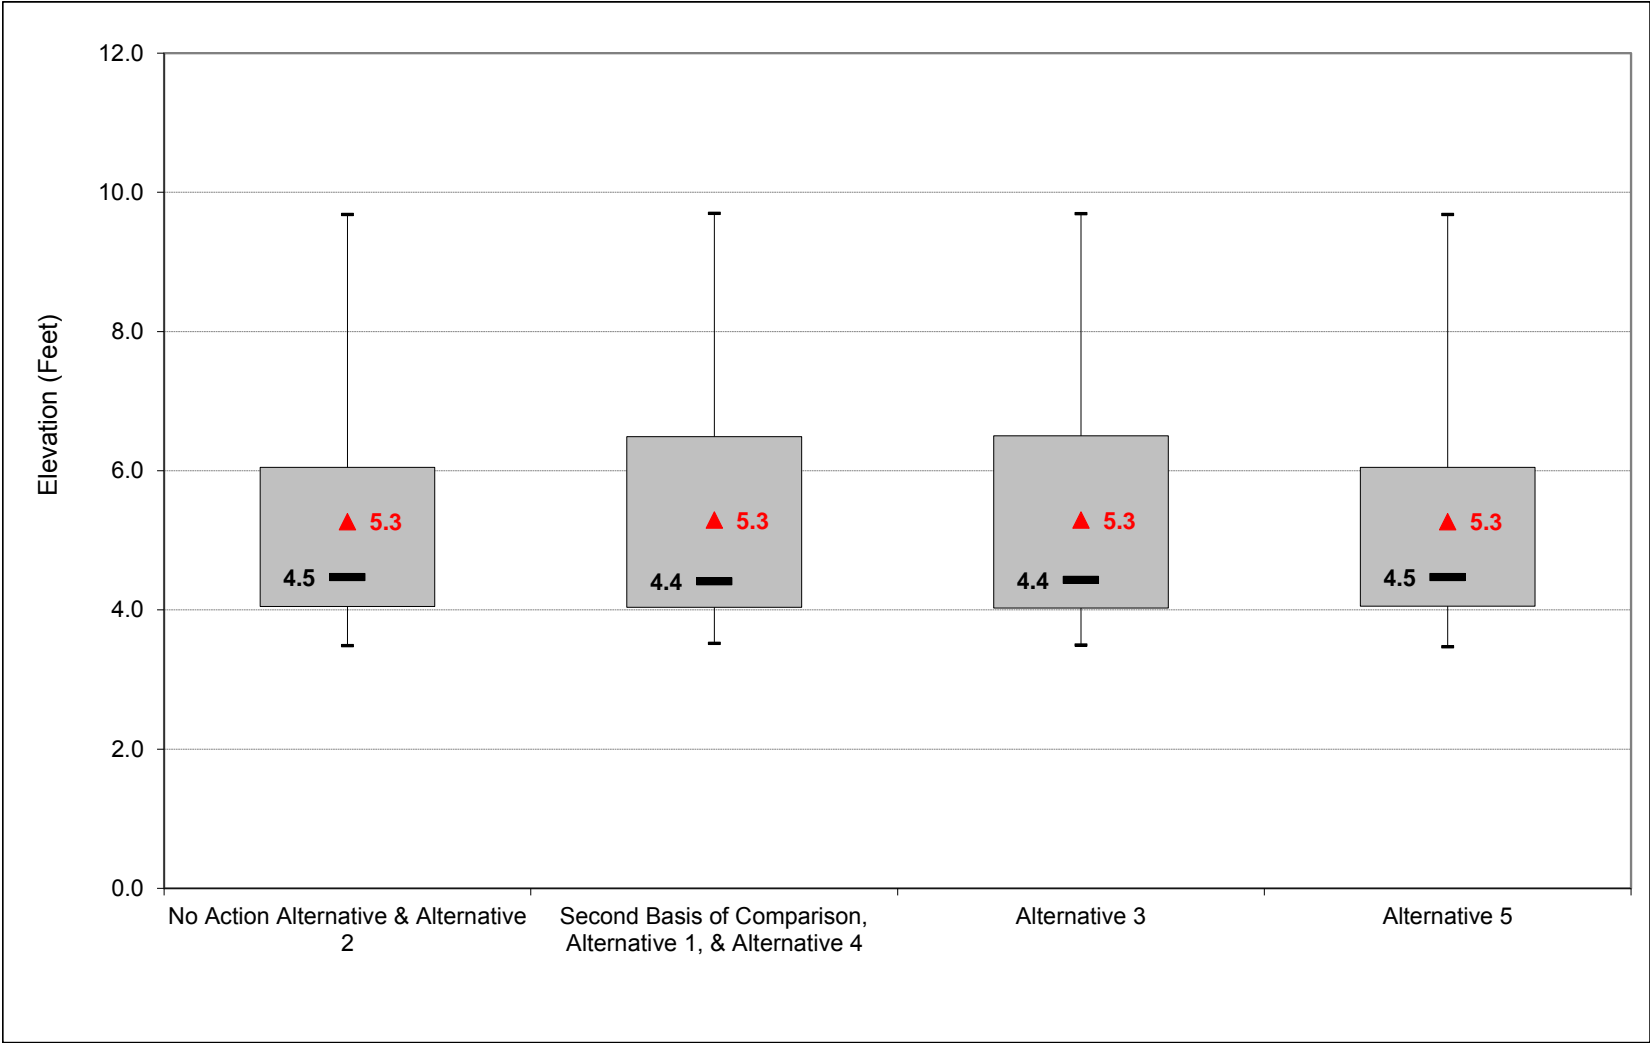


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-44-1-5. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Maximum Elevation, February

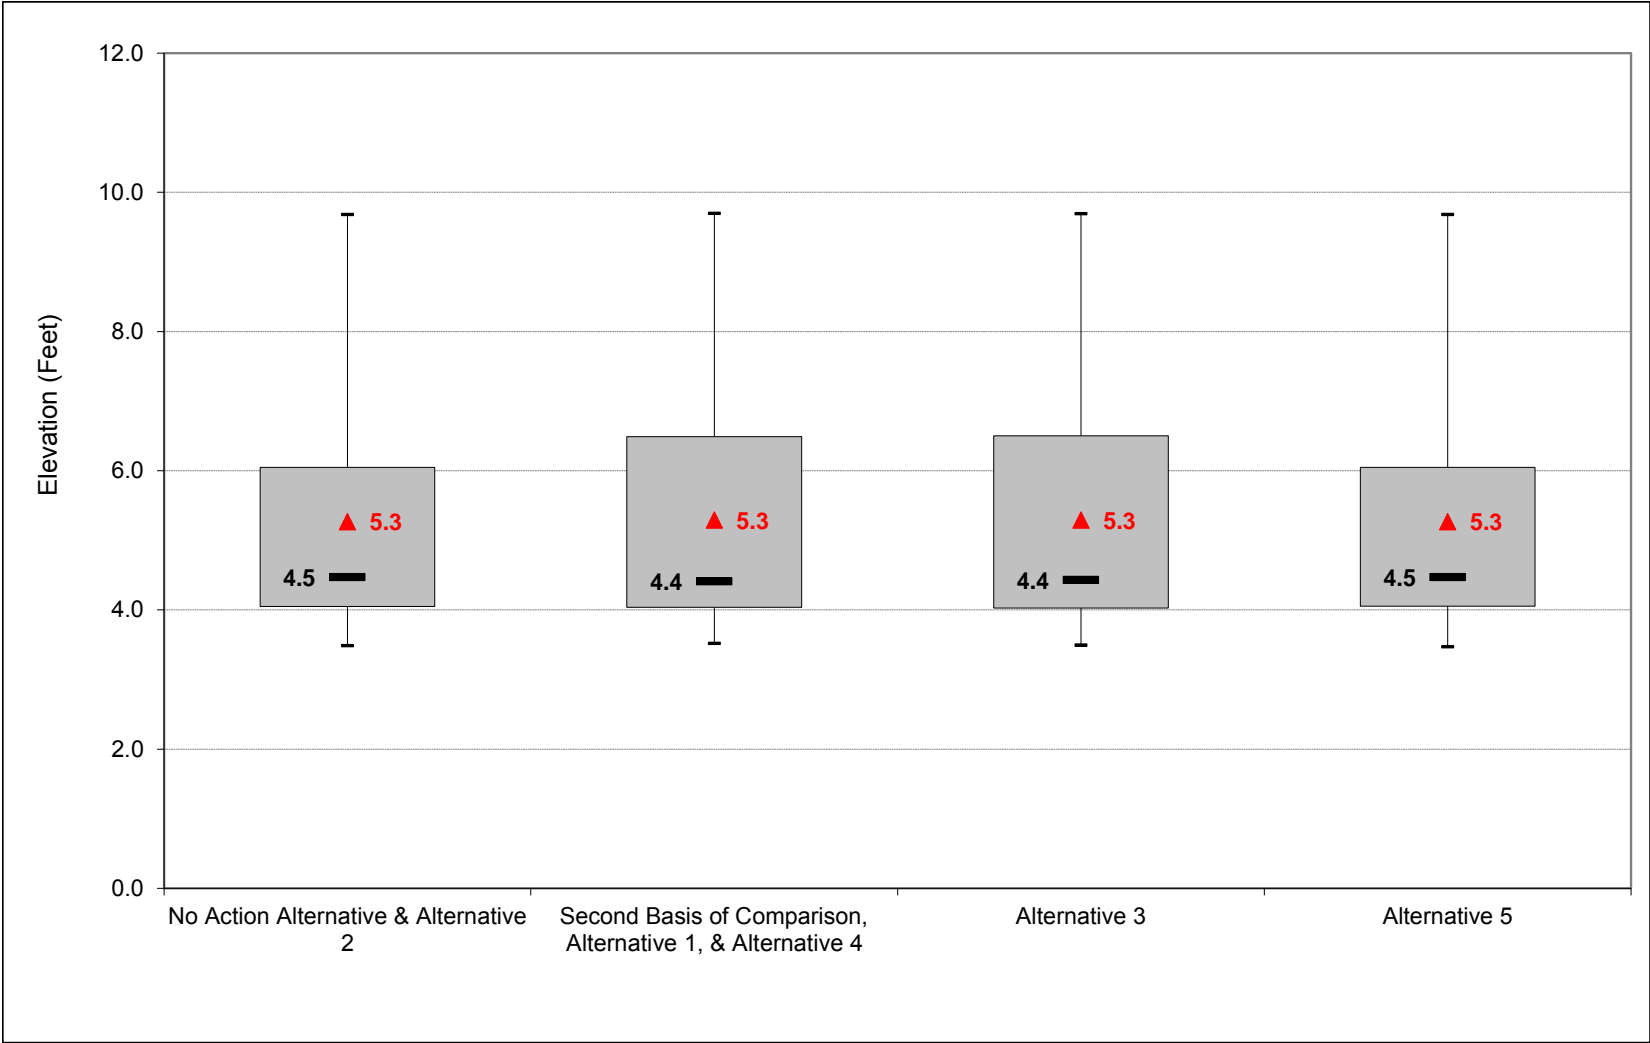


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-44-1-6. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Maximum Elevation, March

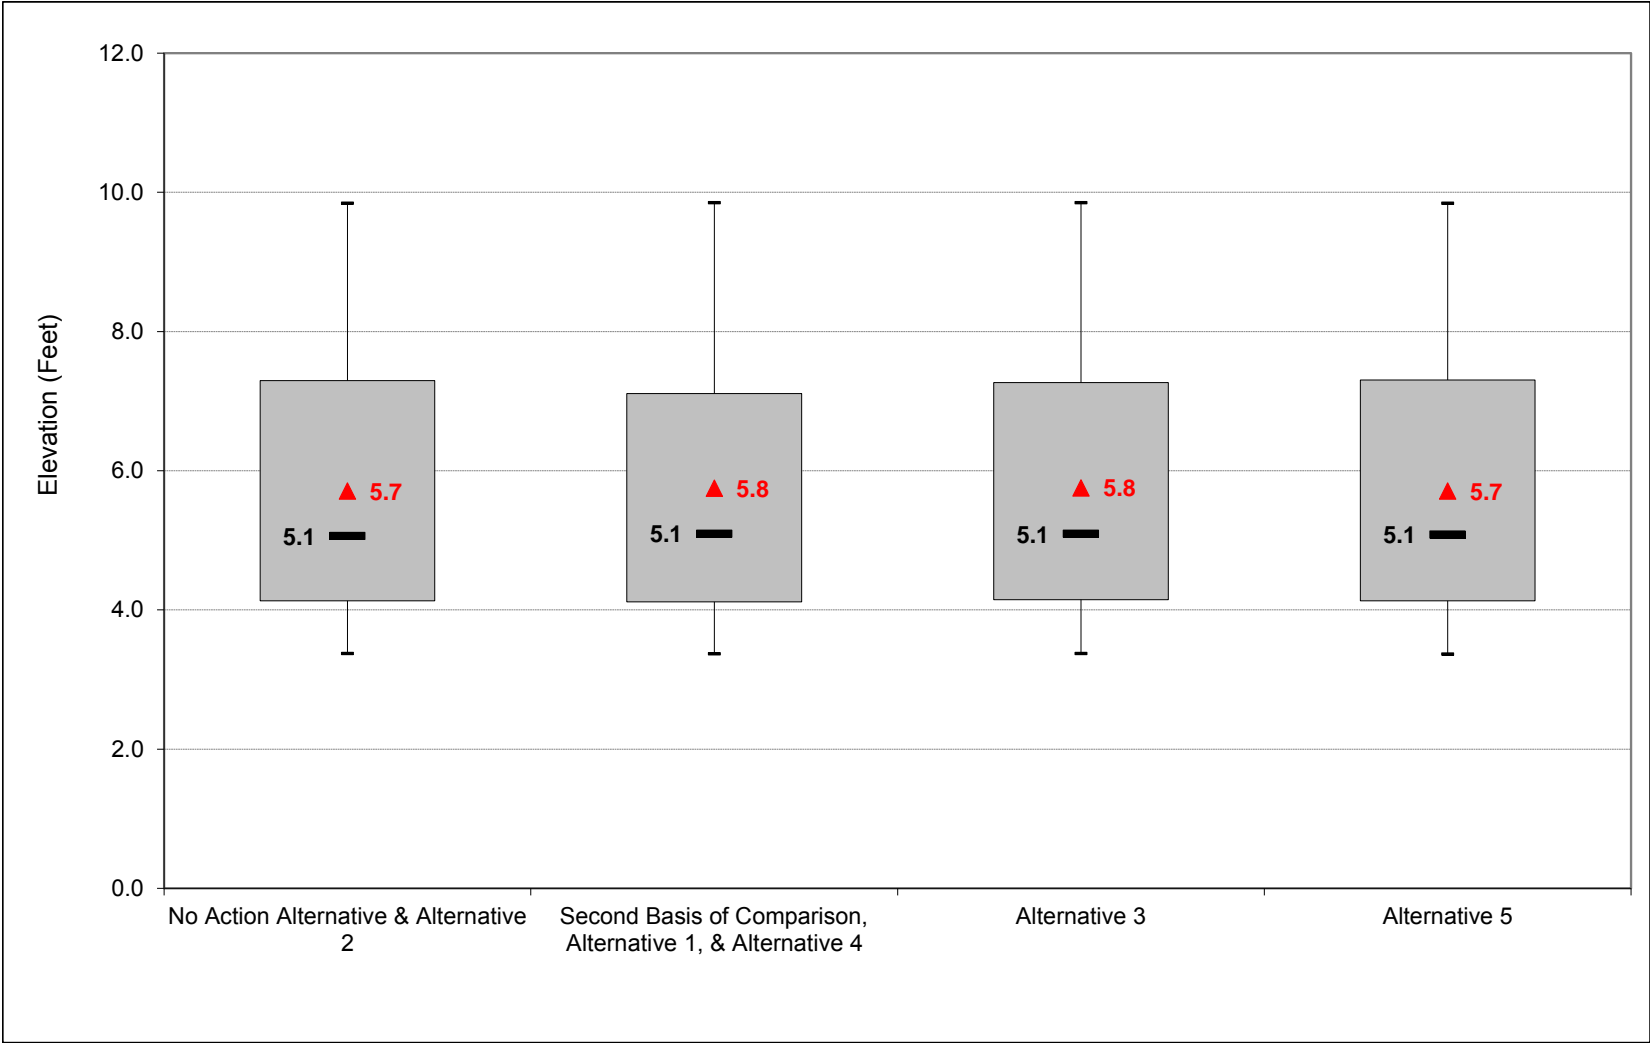


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-44-1-7. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Maximum Elevation, April

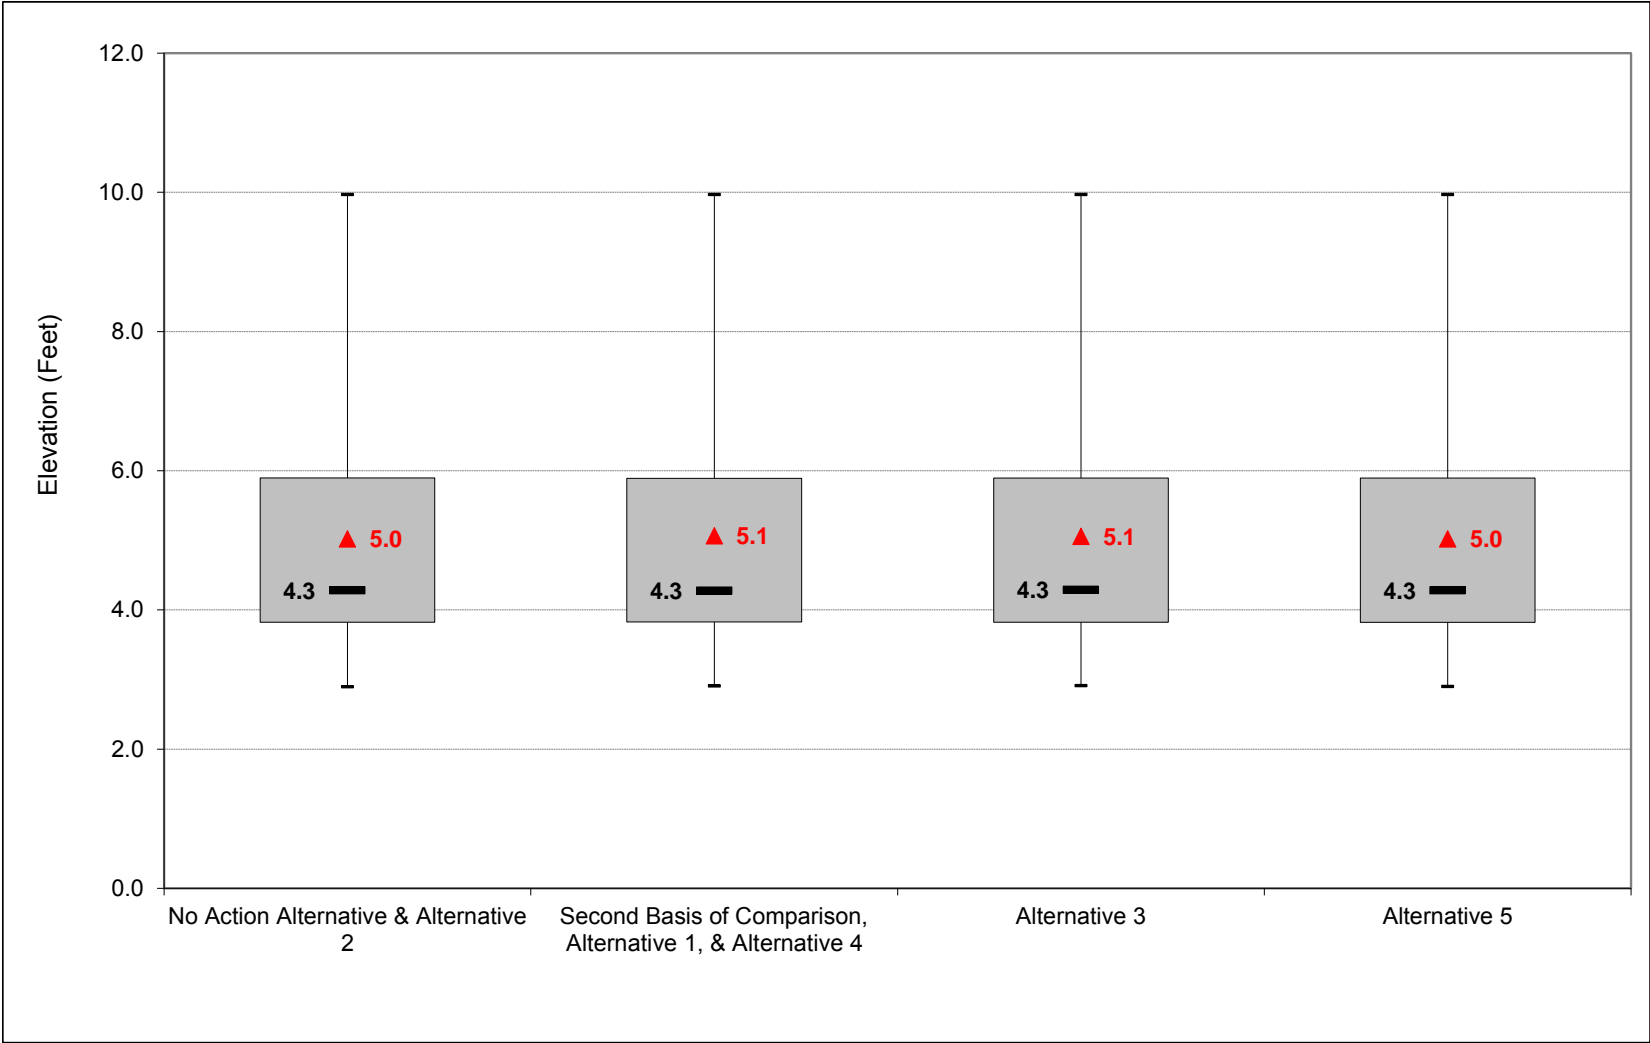


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-44-1-8. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Maximum Elevation, May

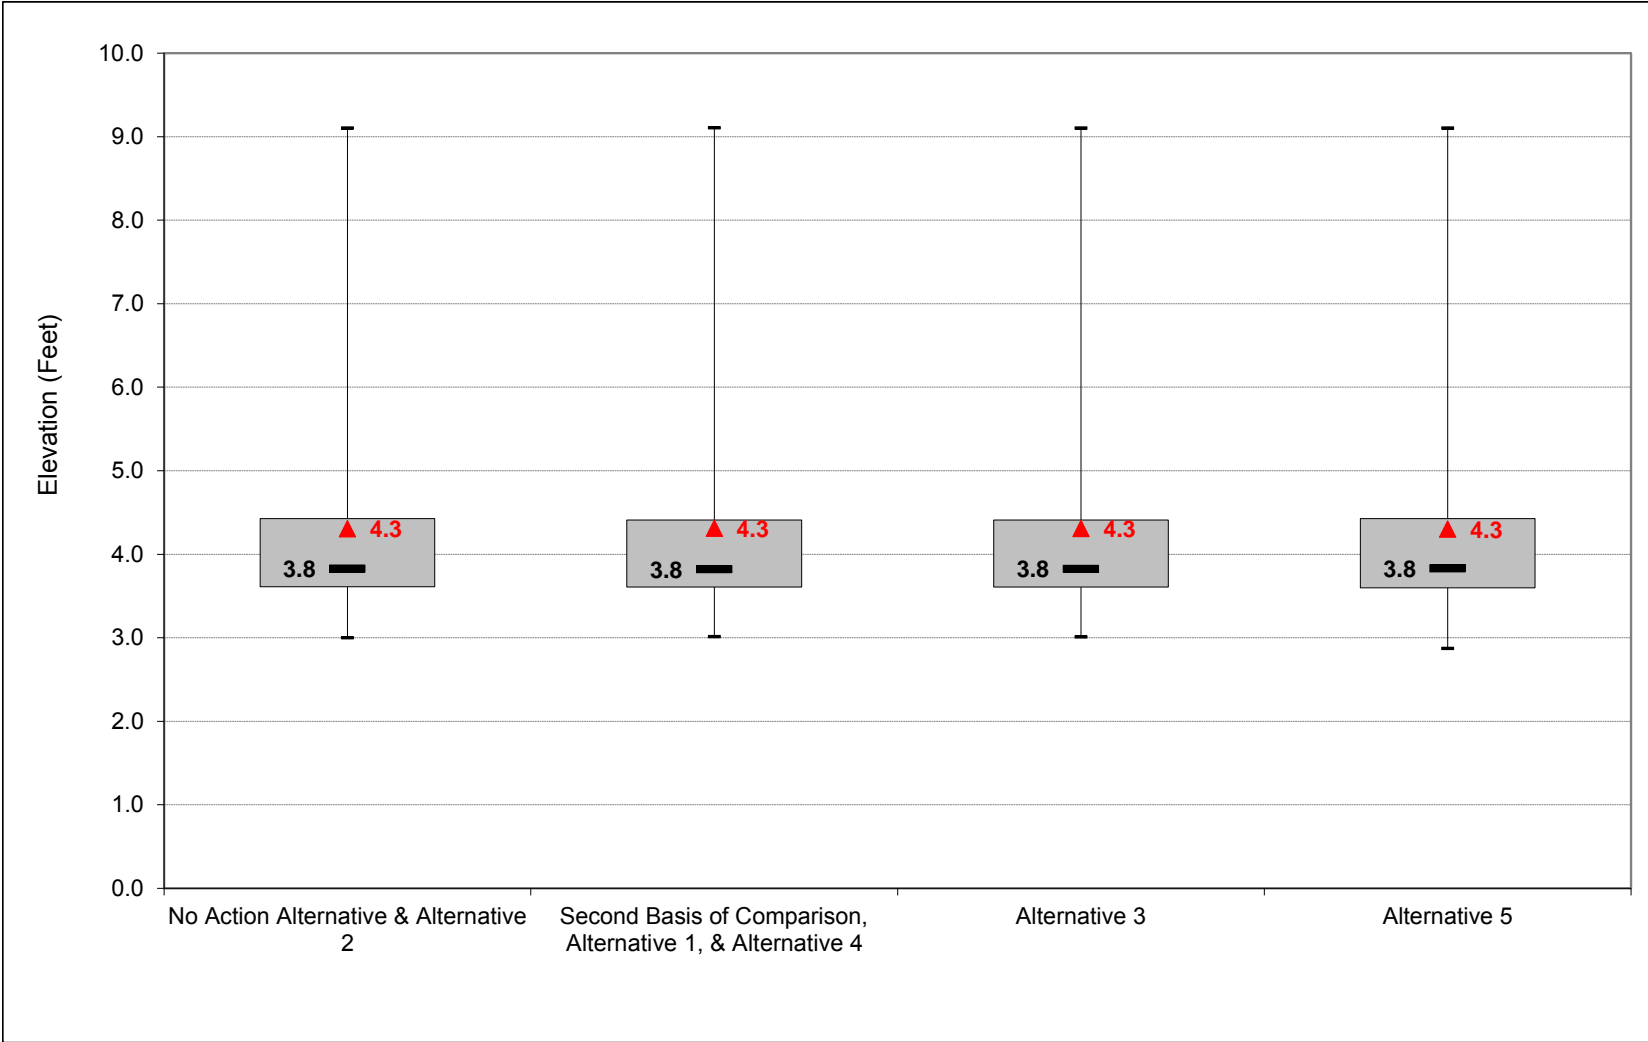


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-44-1-9. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Maximum Elevation, June

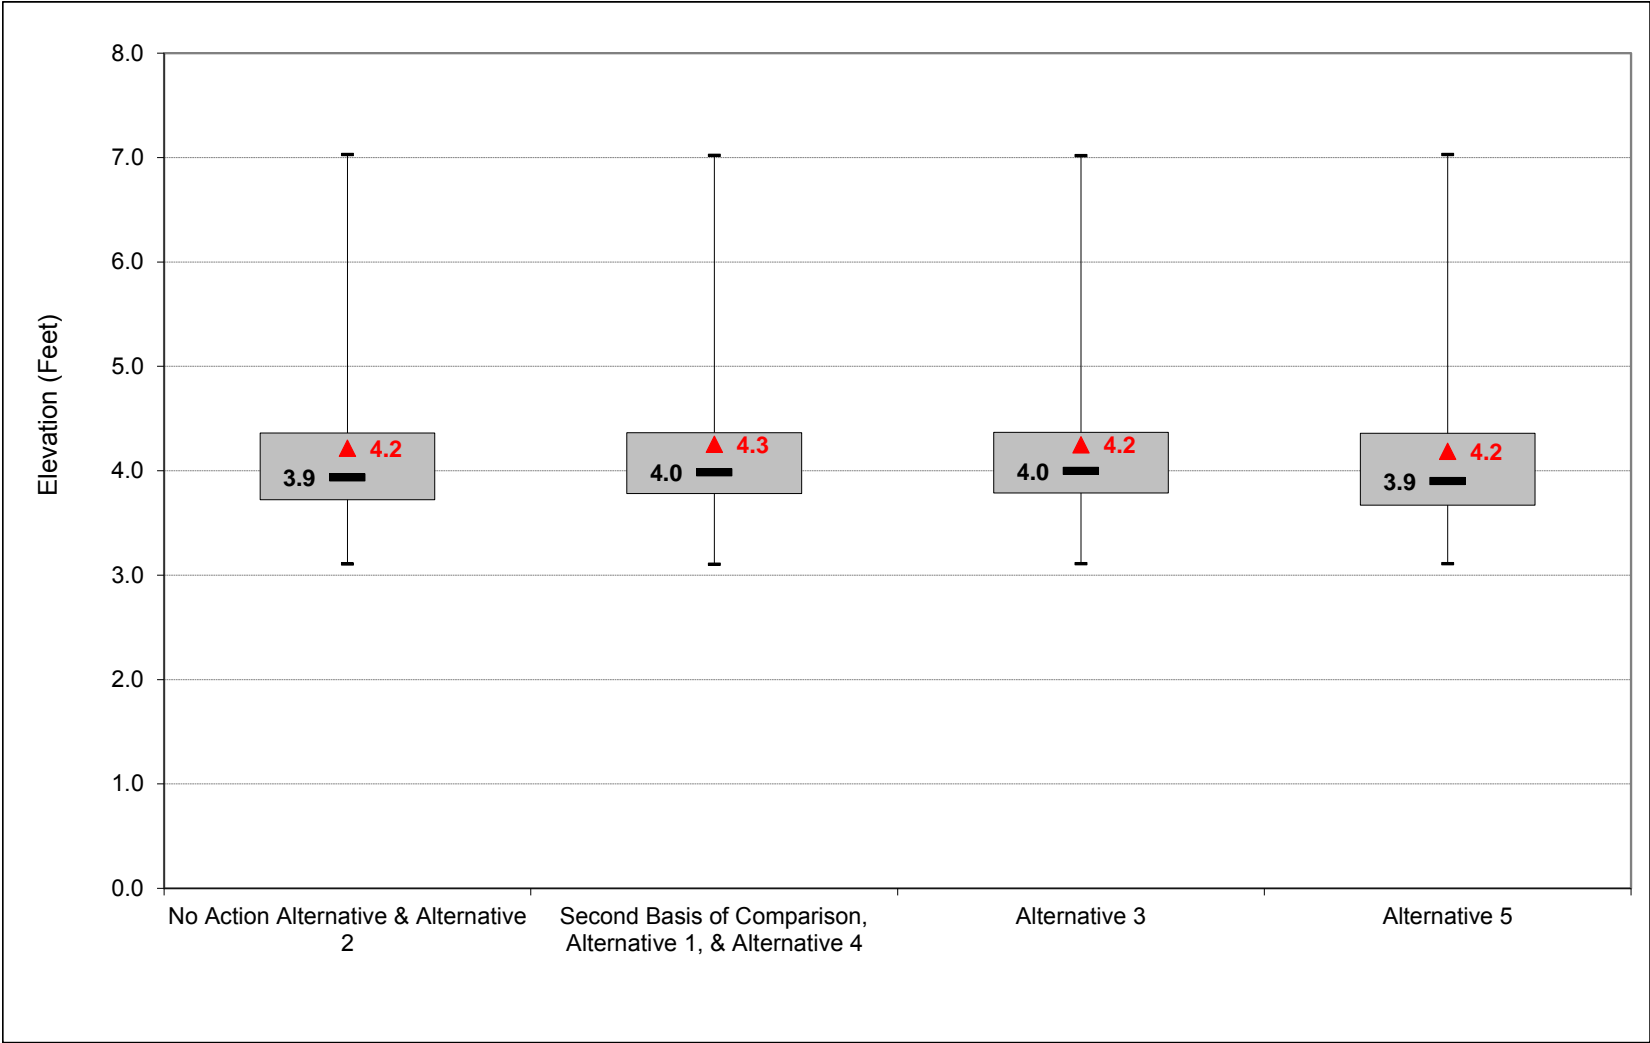


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-44-1-10. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Maximum Elevation, July

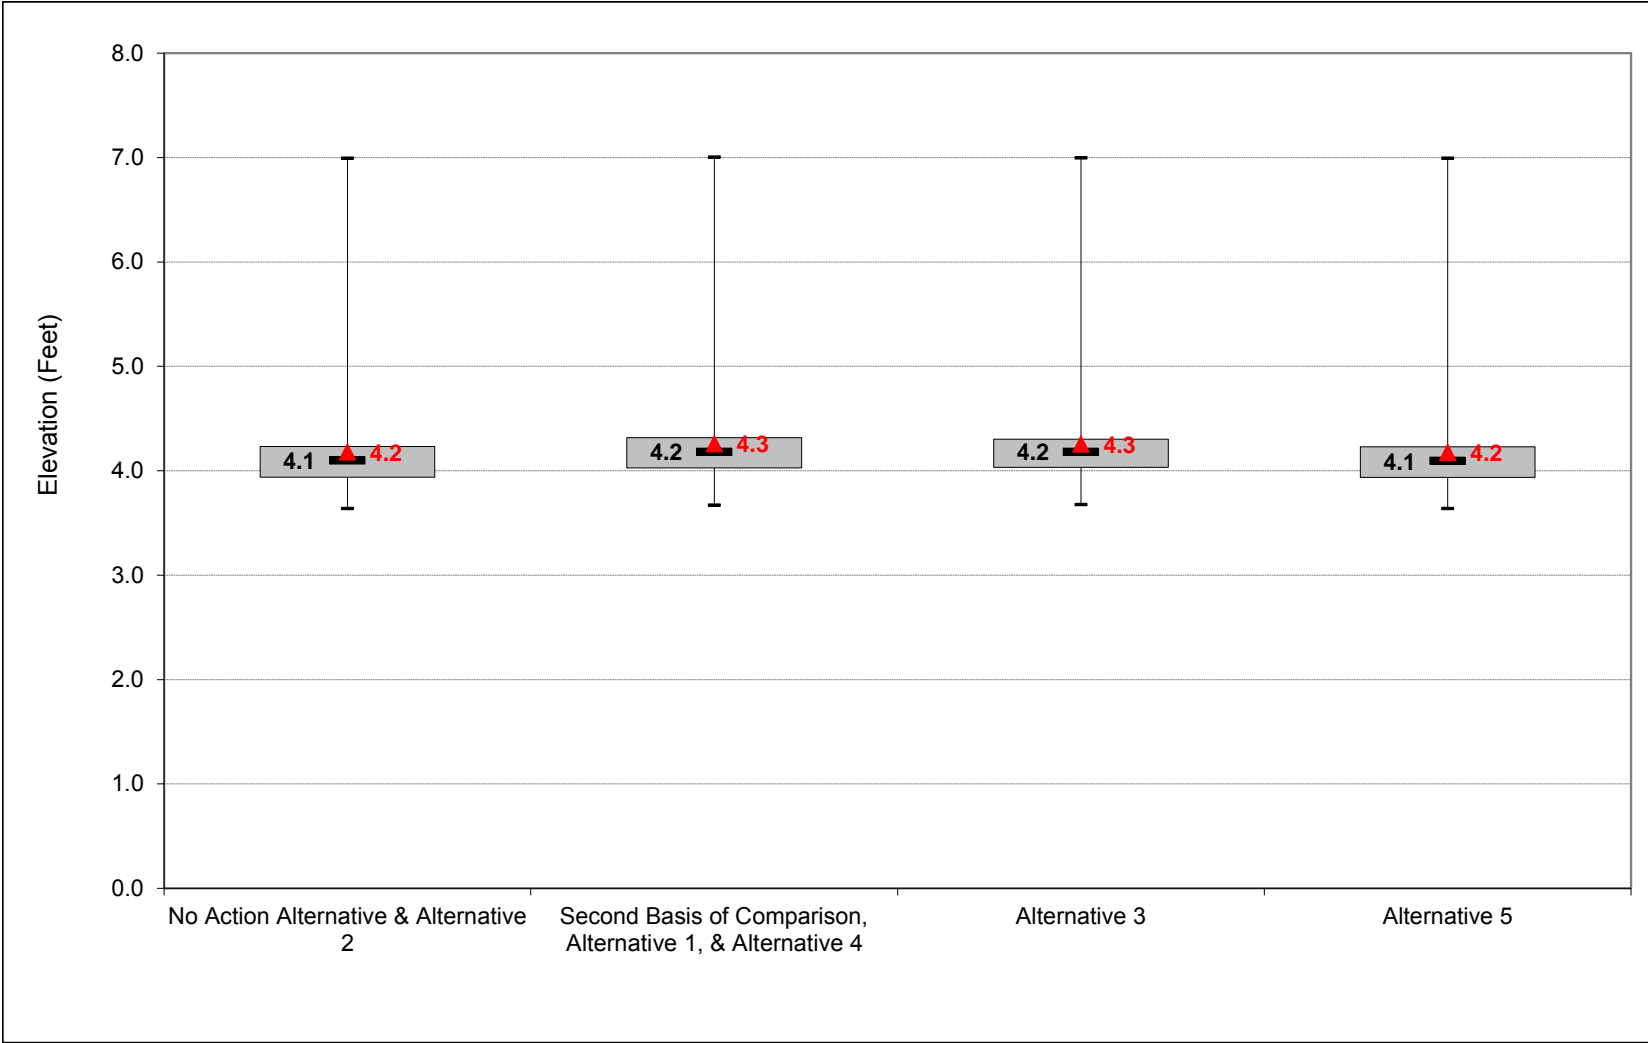


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-44-1-11. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Maximum Elevation, August

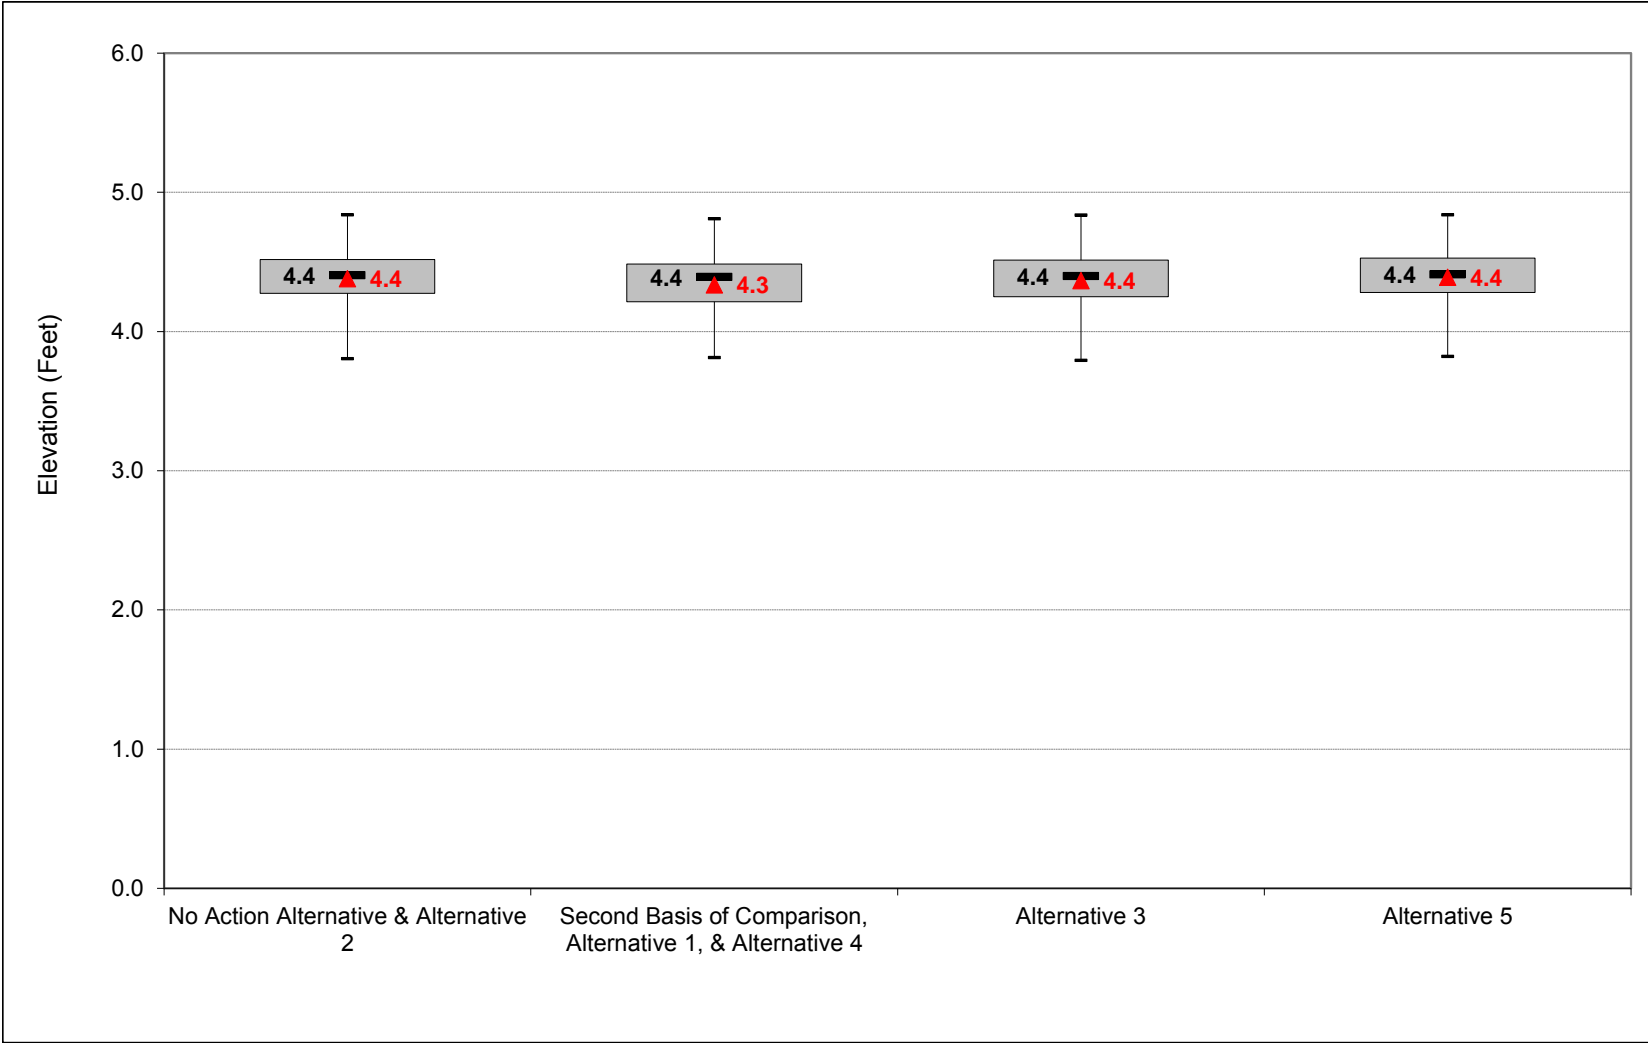

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-44-1-12. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Maximum Elevation, September

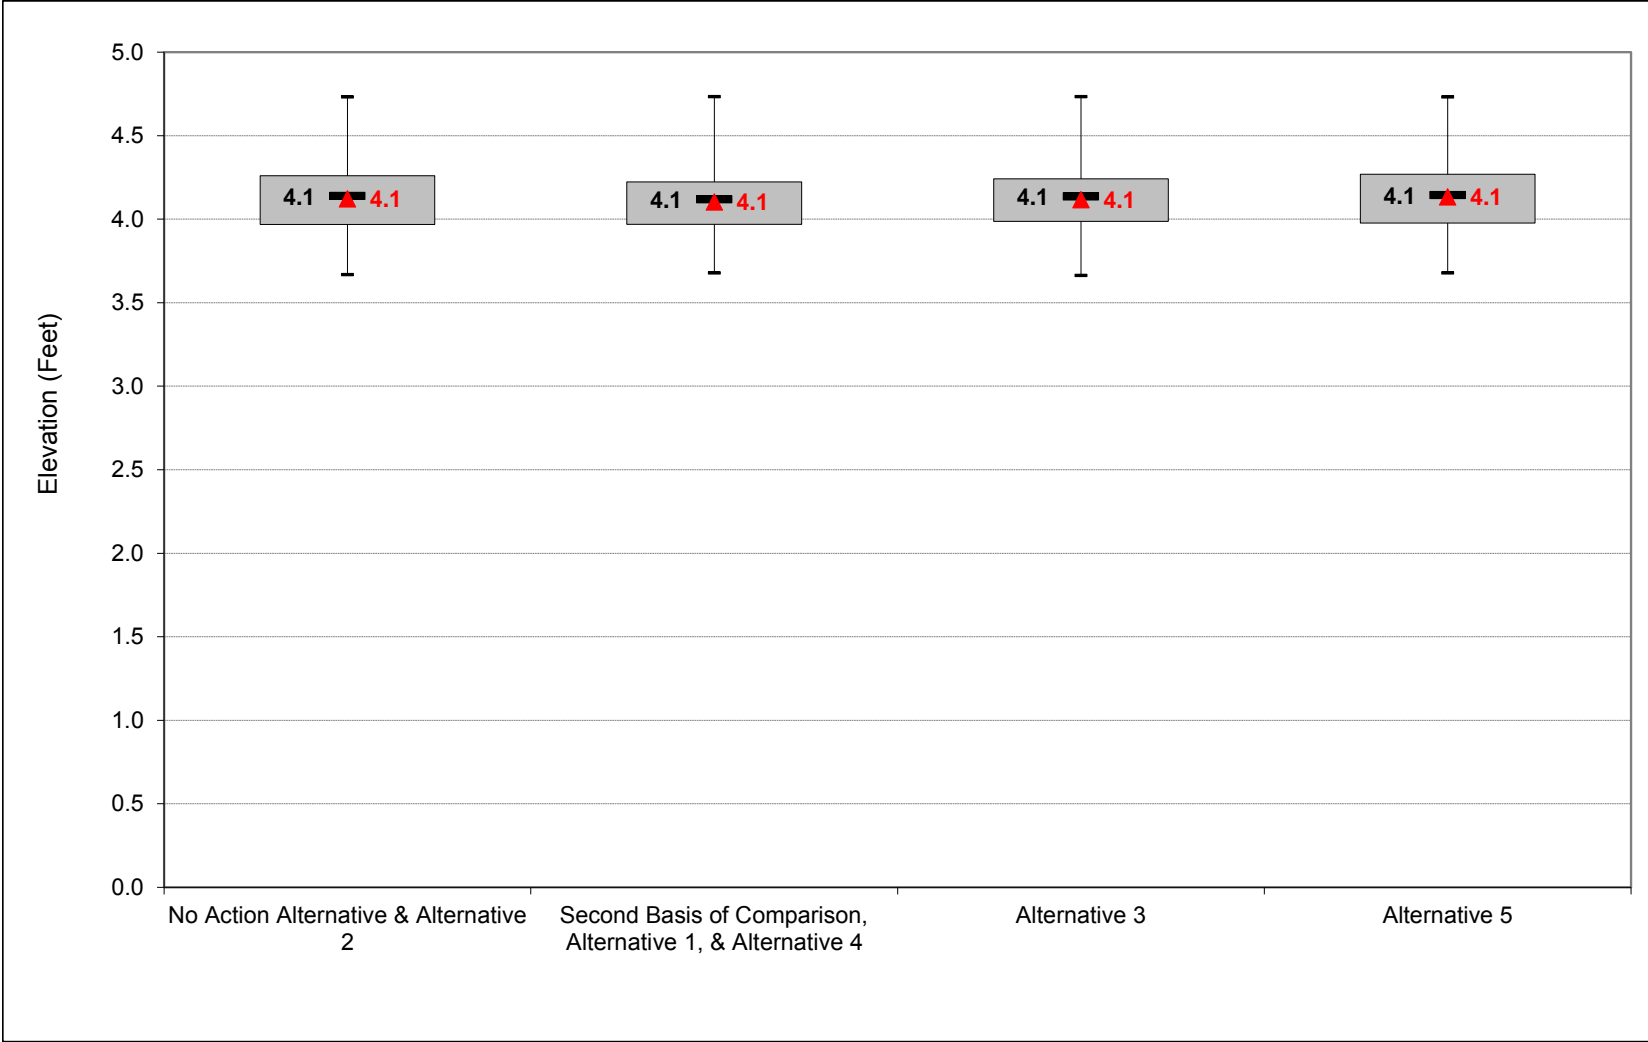

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-44-1-1. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Maximum Elevation

No Action Alternative

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4.0	4.5	6.6	8.1	8.7	7.9	6.3	5.4	4.5	4.6	4.3	4.8
20%	3.9	4.3	5.2	6.9	7.8	6.6	5.0	4.5	4.3	4.5	4.3	4.7
30%	3.8	4.2	4.5	5.6	6.6	5.2	4.2	4.2	4.2	4.5	4.3	4.4
40%	3.7	4.0	4.3	4.7	5.9	4.6	4.0	4.0	4.2	4.4	4.2	4.2
50%	3.7	3.9	4.2	4.5	5.1	4.3	3.8	3.9	4.1	4.4	4.1	4.1
60%	3.6	3.8	4.1	4.2	4.4	4.1	3.7	3.8	4.0	4.4	4.1	3.9
70%	3.6	3.7	3.9	4.1	4.2	3.9	3.6	3.8	4.0	4.3	4.0	3.9
80%	3.5	3.6	3.8	4.0	4.1	3.7	3.5	3.7	3.9	4.2	3.9	3.8
90%	3.4	3.5	3.7	3.8	3.9	3.6	3.4	3.6	3.8	4.1	3.9	3.6
Long Term												
Full Simulation Period ^b	3.7	4.0	4.6	5.3	5.7	5.0	4.3	4.2	4.2	4.4	4.1	4.2
Water Year Types^c												
Wet (32%)	3.9	4.4	5.7	6.8	7.3	6.5	5.3	5.0	4.5	4.5	4.2	4.7
Above Normal (16%)	3.7	4.1	4.8	5.8	6.5	5.7	4.4	4.2	4.1	4.5	4.2	4.2
Below Normal (13%)	3.7	4.0	4.2	4.3	5.0	3.9	3.7	3.8	4.1	4.5	4.2	4.0
Dry (24%)	3.6	3.8	3.9	4.2	4.4	4.2	3.7	3.8	4.0	4.3	4.0	3.8
Critical (15%)	3.6	3.6	3.9	4.0	4.1	3.7	3.5	3.6	3.9	4.1	3.9	3.7

Alternative 1

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3.9	4.4	7.1	8.2	8.8	7.9	6.3	5.4	4.6	4.5	4.3	4.2
20%	3.8	4.1	5.4	7.3	7.9	6.6	5.0	4.6	4.4	4.5	4.2	4.1
30%	3.8	3.9	4.5	5.7	6.7	5.7	4.2	4.2	4.3	4.5	4.2	4.1
40%	3.7	3.8	4.2	4.7	6.1	4.6	4.0	4.0	4.2	4.4	4.2	4.0
50%	3.7	3.8	4.1	4.4	5.1	4.3	3.8	4.0	4.2	4.4	4.1	3.9
60%	3.6	3.7	4.0	4.2	4.4	4.1	3.8	3.9	4.1	4.3	4.1	3.8
70%	3.6	3.6	3.9	4.1	4.3	3.9	3.7	3.8	4.1	4.2	4.0	3.8
80%	3.5	3.6	3.8	3.9	4.0	3.8	3.5	3.7	4.0	4.2	4.0	3.8
90%	3.4	3.4	3.7	3.8	3.9	3.6	3.4	3.6	3.9	4.1	3.9	3.6
Long Term												
Full Simulation Period ^b	3.7	3.9	4.7	5.3	5.8	5.1	4.3	4.3	4.3	4.3	4.1	3.9
Water Year Types^c												
Wet (32%)	3.8	4.2	5.8	6.9	7.4	6.5	5.3	5.0	4.5	4.4	4.2	4.1
Above Normal (16%)	3.7	4.0	4.7	5.8	6.6	5.8	4.4	4.2	4.2	4.5	4.2	4.0
Below Normal (13%)	3.7	3.9	4.1	4.3	5.2	3.9	3.7	4.0	4.2	4.4	4.2	4.0
Dry (24%)	3.6	3.7	3.9	4.2	4.4	4.2	3.7	3.9	4.1	4.2	4.0	3.8
Critical (15%)	3.6	3.6	3.9	4.0	4.0	3.7	3.6	3.6	3.9	4.1	3.9	3.7

Alternative 1 minus No Action Alternative

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-0.1	0.0	0.5	0.1	0.0	0.0	0.0	0.0	0.1	-0.1	0.0	-0.6
20%	-0.1	-0.1	0.2	0.4	0.0	0.0	0.0	0.0	0.1	0.0	-0.1	-0.6
30%	-0.1	-0.2	0.0	0.2	0.1	0.5	0.0	0.1	0.1	-0.1	-0.1	-0.3
40%	0.0	-0.2	0.0	0.0	0.2	0.0	0.0	0.0	0.1	0.0	0.0	-0.2
50%	0.0	-0.1	-0.1	-0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-0.1
60%	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.1	-0.1	0.0	-0.1
70%	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.1	-0.1	0.0	-0.1
80%	0.0	0.0	0.0	-0.1	-0.1	0.0	0.1	0.1	0.1	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-0.2
Water Year Types^c												
Wet (32%)	-0.1	-0.1	0.2	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.6
Above Normal (16%)	0.0	-0.1	-0.1	0.0	0.1	0.2	0.0	0.1	0.1	0.0	0.0	-0.2
Below Normal (13%)	0.0	-0.1	0.0	0.0	0.1	0.0	0.0	0.1	0.2	0.0	-0.1	0.0
Dry (24%)	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-44-1-2. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Maximum Elevation

No Action Alternative

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4.0	4.5	6.6	8.1	8.7	7.9	6.3	5.4	4.5	4.6	4.3	4.8
20%	3.9	4.3	5.2	6.9	7.8	6.6	5.0	4.5	4.3	4.5	4.3	4.7
30%	3.8	4.2	4.5	5.6	6.6	5.2	4.2	4.2	4.2	4.5	4.3	4.4
40%	3.7	4.0	4.3	4.7	5.9	4.6	4.0	4.0	4.2	4.4	4.2	4.2
50%	3.7	3.9	4.2	4.5	5.1	4.3	3.8	3.9	4.1	4.4	4.1	4.1
60%	3.6	3.8	4.1	4.2	4.4	4.1	3.7	3.8	4.0	4.4	4.1	3.9
70%	3.6	3.7	3.9	4.1	4.2	3.9	3.6	3.8	4.0	4.3	4.0	3.9
80%	3.5	3.6	3.8	4.0	4.1	3.7	3.5	3.7	3.9	4.2	3.9	3.8
90%	3.4	3.5	3.7	3.8	3.9	3.6	3.4	3.6	3.8	4.1	3.9	3.6
Long Term												
Full Simulation Period ^b	3.7	4.0	4.6	5.3	5.7	5.0	4.3	4.2	4.2	4.4	4.1	4.2
Water Year Types^c												
Wet (32%)	3.9	4.4	5.7	6.8	7.3	6.5	5.3	5.0	4.5	4.5	4.2	4.7
Above Normal (16%)	3.7	4.1	4.8	5.8	6.5	5.7	4.4	4.2	4.1	4.5	4.2	4.2
Below Normal (13%)	3.7	4.0	4.2	4.3	5.0	3.9	3.7	3.8	4.1	4.5	4.2	4.0
Dry (24%)	3.6	3.8	3.9	4.2	4.4	4.2	3.7	3.8	4.0	4.3	4.0	3.8
Critical (15%)	3.6	3.6	3.9	4.0	4.1	3.7	3.5	3.6	3.9	4.1	3.9	3.7

Alternative 3

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3.9	4.4	7.1	8.2	8.8	7.9	6.3	5.4	4.5	4.6	4.3	4.2
20%	3.8	4.1	5.4	7.3	7.9	6.6	5.0	4.5	4.3	4.5	4.3	4.1
30%	3.8	3.9	4.5	5.7	6.7	5.4	4.2	4.2	4.3	4.5	4.2	4.0
40%	3.7	3.8	4.2	4.7	6.1	4.6	4.0	4.1	4.2	4.4	4.2	4.0
50%	3.7	3.7	4.1	4.4	5.1	4.3	3.8	4.0	4.2	4.4	4.1	3.9
60%	3.6	3.7	4.0	4.2	4.3	4.1	3.7	3.9	4.1	4.3	4.1	3.9
70%	3.6	3.6	3.9	4.1	4.3	3.9	3.7	3.8	4.0	4.3	4.0	3.8
80%	3.5	3.6	3.8	4.0	4.0	3.8	3.5	3.7	4.0	4.2	3.9	3.8
90%	3.4	3.4	3.7	3.8	3.9	3.6	3.4	3.6	3.9	4.1	3.9	3.7
Long Term												
Full Simulation Period ^b	3.7	3.9	4.7	5.3	5.8	5.1	4.3	4.2	4.3	4.4	4.1	3.9
Water Year Types^c												
Wet (32%)	3.8	4.2	5.8	6.9	7.4	6.5	5.3	5.0	4.6	4.5	4.2	4.1
Above Normal (16%)	3.6	4.0	4.7	5.8	6.6	5.8	4.4	4.2	4.2	4.5	4.2	4.0
Below Normal (13%)	3.7	3.9	4.1	4.3	5.2	3.9	3.7	3.9	4.2	4.5	4.2	4.0
Dry (24%)	3.6	3.7	3.9	4.2	4.4	4.2	3.7	3.9	4.1	4.3	4.0	3.8
Critical (15%)	3.6	3.6	3.9	4.0	4.1	3.7	3.6	3.6	3.9	4.1	3.9	3.7

Alternative 3 minus No Action Alternative

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-0.1	-0.1	0.5	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.6
20%	-0.1	-0.1	0.3	0.4	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-0.6
30%	-0.1	-0.3	0.0	0.2	0.1	0.3	0.0	0.0	0.1	0.0	0.0	-0.4
40%	0.0	-0.2	0.0	0.0	0.2	0.0	0.0	0.0	0.1	0.0	0.0	-0.2
50%	0.0	-0.2	-0.1	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	-0.1
60%	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	-0.1
70%	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	-0.1
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-0.2
Water Year Types^c												
Wet (32%)	-0.1	-0.1	0.2	0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-0.6
Above Normal (16%)	0.0	-0.1	-0.1	0.0	0.1	0.1	0.0	0.0	0.1	0.0	0.0	-0.2
Below Normal (13%)	-0.1	-0.1	0.0	0.0	0.1	0.0	0.0	0.1	0.1	0.0	0.0	0.0
Dry (24%)	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-44-1-3. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Maximum Elevation

No Action Alternative

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4.0	4.5	6.6	8.1	8.7	7.9	6.3	5.4	4.5	4.6	4.3	4.8
20%	3.9	4.3	5.2	6.9	7.8	6.6	5.0	4.5	4.3	4.5	4.3	4.7
30%	3.8	4.2	4.5	5.6	6.6	5.2	4.2	4.2	4.2	4.5	4.3	4.4
40%	3.7	4.0	4.3	4.7	5.9	4.6	4.0	4.0	4.2	4.4	4.2	4.2
50%	3.7	3.9	4.2	4.5	5.1	4.3	3.8	3.9	4.1	4.4	4.1	4.1
60%	3.6	3.8	4.1	4.2	4.4	4.1	3.7	3.8	4.0	4.4	4.1	3.9
70%	3.6	3.7	3.9	4.1	4.2	3.9	3.6	3.8	4.0	4.3	4.0	3.9
80%	3.5	3.6	3.8	4.0	4.1	3.7	3.5	3.7	3.9	4.2	3.9	3.8
90%	3.4	3.5	3.7	3.8	3.9	3.6	3.4	3.6	3.8	4.1	3.9	3.6
Long Term												
Full Simulation Period ^b	3.7	4.0	4.6	5.3	5.7	5.0	4.3	4.2	4.2	4.4	4.1	4.2
Water Year Types^c												
Wet (32%)	3.9	4.4	5.7	6.8	7.3	6.5	5.3	5.0	4.5	4.5	4.2	4.7
Above Normal (16%)	3.7	4.1	4.8	5.8	6.5	5.7	4.4	4.2	4.1	4.5	4.2	4.2
Below Normal (13%)	3.7	4.0	4.2	4.3	5.0	3.9	3.7	3.8	4.1	4.5	4.2	4.0
Dry (24%)	3.6	3.8	3.9	4.2	4.4	4.2	3.7	3.8	4.0	4.3	4.0	3.8
Critical (15%)	3.6	3.6	3.9	4.0	4.1	3.7	3.5	3.6	3.9	4.1	3.9	3.7

Alternative 5

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4.0	4.5	6.6	8.1	8.7	7.9	6.3	5.4	4.5	4.6	4.3	4.8
20%	3.9	4.3	5.2	6.9	7.8	6.6	5.0	4.5	4.3	4.5	4.3	4.7
30%	3.8	4.2	4.5	5.6	6.6	5.2	4.2	4.1	4.2	4.5	4.3	4.4
40%	3.7	4.0	4.3	4.7	5.9	4.6	4.0	4.0	4.1	4.4	4.2	4.2
50%	3.7	3.9	4.1	4.5	5.1	4.3	3.8	3.9	4.1	4.4	4.1	4.1
60%	3.7	3.8	4.1	4.2	4.4	4.1	3.7	3.8	4.1	4.4	4.1	4.0
70%	3.6	3.7	3.9	4.1	4.2	3.9	3.6	3.7	3.9	4.3	4.1	3.9
80%	3.5	3.6	3.8	4.0	4.1	3.7	3.5	3.6	3.9	4.2	3.9	3.8
90%	3.4	3.5	3.7	3.8	3.9	3.6	3.4	3.5	3.8	4.2	3.9	3.6
Long Term												
Full Simulation Period ^b	3.7	4.0	4.6	5.3	5.7	5.0	4.3	4.2	4.2	4.4	4.1	4.2
Water Year Types^c												
Wet (32%)	3.9	4.4	5.7	6.8	7.3	6.5	5.3	5.0	4.5	4.5	4.2	4.7
Above Normal (16%)	3.7	4.1	4.8	5.8	6.5	5.7	4.4	4.2	4.1	4.5	4.2	4.2
Below Normal (13%)	3.7	4.0	4.2	4.3	5.0	3.9	3.7	3.8	4.1	4.5	4.2	4.0
Dry (24%)	3.6	3.8	3.9	4.2	4.4	4.2	3.7	3.8	4.0	4.3	4.0	3.8
Critical (15%)	3.6	3.6	3.9	4.0	4.1	3.7	3.5	3.5	3.9	4.1	3.9	3.7

Alternative 5 minus No Action Alternative

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
30%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.1	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-44-1-4. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Maximum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.9	4.4	7.1	8.2	8.8	7.9	6.3	5.4	4.6	4.5	4.3	4.2
20%	3.8	4.1	5.4	7.3	7.9	6.6	5.0	4.6	4.4	4.5	4.2	4.1
30%	3.8	3.9	4.5	5.7	6.7	5.7	4.2	4.2	4.3	4.5	4.2	4.1
40%	3.7	3.8	4.2	4.7	6.1	4.6	4.0	4.0	4.2	4.4	4.2	4.0
50%	3.7	3.8	4.1	4.4	5.1	4.3	3.8	4.0	4.2	4.4	4.1	3.9
60%	3.6	3.7	4.0	4.2	4.4	4.1	3.8	3.9	4.1	4.3	4.1	3.8
70%	3.6	3.6	3.9	4.1	4.3	3.9	3.7	3.8	4.1	4.2	4.0	3.8
80%	3.5	3.6	3.8	3.9	4.0	3.8	3.5	3.7	4.0	4.2	4.0	3.8
90%	3.4	3.4	3.7	3.8	3.9	3.6	3.4	3.6	3.9	4.1	3.9	3.6
Long Term												
Full Simulation Period ^b	3.7	3.9	4.7	5.3	5.8	5.1	4.3	4.3	4.3	4.3	4.1	3.9
Water Year Types ^c												
Wet (32%)	3.8	4.2	5.8	6.9	7.4	6.5	5.3	5.0	4.5	4.4	4.2	4.1
Above Normal (16%)	3.7	4.0	4.7	5.8	6.6	5.8	4.4	4.2	4.2	4.5	4.2	4.0
Below Normal (13%)	3.7	3.9	4.1	4.3	5.2	3.9	3.7	4.0	4.2	4.4	4.2	4.0
Dry (24%)	3.6	3.7	3.9	4.2	4.4	4.2	3.7	3.9	4.1	4.2	4.0	3.8
Critical (15%)	3.6	3.6	3.9	4.0	4.0	3.7	3.6	3.6	3.9	4.1	3.9	3.7

No Action Alternative

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	4.0	4.5	6.6	8.1	8.7	7.9	6.3	5.4	4.5	4.6	4.3	4.8
20%	3.9	4.3	5.2	6.9	7.8	6.6	5.0	4.5	4.3	4.5	4.3	4.7
30%	3.8	4.2	4.5	5.6	6.6	5.2	4.2	4.2	4.2	4.5	4.3	4.4
40%	3.7	4.0	4.3	4.7	5.9	4.6	4.0	4.0	4.2	4.4	4.2	4.2
50%	3.7	3.9	4.2	4.5	5.1	4.3	3.8	3.9	4.1	4.4	4.1	4.1
60%	3.6	3.8	4.1	4.2	4.4	4.1	3.7	3.8	4.0	4.4	4.1	3.9
70%	3.6	3.7	3.9	4.1	4.2	3.9	3.6	3.8	4.0	4.3	4.0	3.9
80%	3.5	3.6	3.8	4.0	4.1	3.7	3.5	3.7	3.9	4.2	3.9	3.8
90%	3.4	3.5	3.7	3.8	3.9	3.6	3.4	3.6	3.8	4.1	3.9	3.6
Long Term												
Full Simulation Period ^b	3.7	4.0	4.6	5.3	5.7	5.0	4.3	4.2	4.2	4.4	4.1	4.2
Water Year Types ^c												
Wet (32%)	3.9	4.4	5.7	6.8	7.3	6.5	5.3	5.0	4.5	4.5	4.2	4.7
Above Normal (16%)	3.7	4.1	4.8	5.8	6.5	5.7	4.4	4.2	4.1	4.5	4.2	4.2
Below Normal (13%)	3.7	4.0	4.2	4.3	5.0	3.9	3.7	3.8	4.1	4.5	4.2	4.0
Dry (24%)	3.6	3.8	3.9	4.2	4.4	4.2	3.7	3.8	4.0	4.3	4.0	3.8
Critical (15%)	3.6	3.6	3.9	4.0	4.1	3.7	3.5	3.6	3.9	4.1	3.9	3.7

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.1	0.0	-0.5	-0.1	0.0	0.0	0.0	0.0	-0.1	0.1	0.0	0.6
20%	0.1	0.1	-0.2	-0.4	0.0	0.0	0.0	0.0	-0.1	0.0	0.1	0.6
30%	0.1	0.2	0.0	-0.2	-0.1	-0.5	0.0	0.0	-0.1	-0.1	0.1	0.3
40%	0.0	0.2	0.0	0.0	-0.2	0.0	0.0	0.0	-0.1	0.0	0.0	0.2
50%	0.0	0.1	0.1	0.1	0.0	0.0	0.0	0.0	-0.1	-0.1	0.0	0.1
60%	0.0	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.1	0.0	0.1
70%	0.0	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.1	0.0	0.1
80%	0.0	0.0	0.0	0.1	0.1	0.0	-0.1	-0.1	-0.1	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.2
Water Year Types ^c												
Wet (32%)	0.1	0.1	-0.2	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.6
Above Normal (16%)	0.0	0.1	0.1	0.0	-0.1	-0.2	0.0	-0.1	-0.1	0.0	0.0	0.2
Below Normal (13%)	0.0	0.1	0.0	0.0	-0.1	0.0	0.0	-0.1	-0.2	0.0	0.1	0.0
Dry (24%)	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.0	0.0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-44-1-5. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Maximum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3.9	4.4	7.1	8.2	8.8	7.9	6.3	5.4	4.6	4.5	4.3	4.2
20%	3.8	4.1	5.4	7.3	7.9	6.6	5.0	4.6	4.4	4.5	4.2	4.1
30%	3.8	3.9	4.5	5.7	6.7	5.7	4.2	4.2	4.3	4.5	4.2	4.1
40%	3.7	3.8	4.2	4.7	6.1	4.6	4.0	4.0	4.2	4.4	4.2	4.0
50%	3.7	3.8	4.1	4.4	5.1	4.3	3.8	4.0	4.2	4.4	4.1	3.9
60%	3.6	3.7	4.0	4.2	4.4	4.1	3.8	3.9	4.1	4.3	4.1	3.8
70%	3.6	3.6	3.9	4.1	4.3	3.9	3.7	3.8	4.1	4.2	4.0	3.8
80%	3.5	3.6	3.8	3.9	4.0	3.8	3.5	3.7	4.0	4.2	4.0	3.8
90%	3.4	3.4	3.7	3.8	3.9	3.6	3.4	3.6	3.9	4.1	3.9	3.6
Long Term												
Full Simulation Period ^b	3.7	3.9	4.7	5.3	5.8	5.1	4.3	4.3	4.3	4.3	4.1	3.9
Water Year Types^c												
Wet (32%)	3.8	4.2	5.8	6.9	7.4	6.5	5.3	5.0	4.5	4.4	4.2	4.1
Above Normal (16%)	3.7	4.0	4.7	5.8	6.6	5.8	4.4	4.2	4.2	4.5	4.2	4.0
Below Normal (13%)	3.7	3.9	4.1	4.3	5.2	3.9	3.7	4.0	4.2	4.4	4.2	4.0
Dry (24%)	3.6	3.7	3.9	4.2	4.4	4.2	3.7	3.9	4.1	4.2	4.0	3.8
Critical (15%)	3.6	3.6	3.9	4.0	4.0	3.7	3.6	3.6	3.9	4.1	3.9	3.7

Alternative 3

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3.9	4.4	7.1	8.2	8.8	7.9	6.3	5.4	4.5	4.6	4.3	4.2
20%	3.8	4.1	5.4	7.3	7.9	6.6	5.0	4.5	4.3	4.5	4.3	4.1
30%	3.8	3.9	4.5	5.7	6.7	5.4	4.2	4.2	4.3	4.5	4.2	4.0
40%	3.7	3.8	4.2	4.7	6.1	4.6	4.0	4.1	4.2	4.4	4.2	4.0
50%	3.7	3.7	4.1	4.4	5.1	4.3	3.8	4.0	4.2	4.4	4.1	3.9
60%	3.6	3.7	4.0	4.2	4.3	4.1	3.7	3.9	4.1	4.3	4.1	3.9
70%	3.6	3.6	3.9	4.1	4.3	3.9	3.7	3.8	4.0	4.3	4.0	3.8
80%	3.5	3.6	3.8	4.0	4.0	3.8	3.5	3.7	4.0	4.2	3.9	3.8
90%	3.4	3.4	3.7	3.8	3.9	3.6	3.4	3.6	3.9	4.1	3.9	3.7
Long Term												
Full Simulation Period ^b	3.7	3.9	4.7	5.3	5.8	5.1	4.3	4.2	4.3	4.4	4.1	3.9
Water Year Types^c												
Wet (32%)	3.8	4.2	5.8	6.9	7.4	6.5	5.3	5.0	4.6	4.5	4.2	4.1
Above Normal (16%)	3.6	4.0	4.7	5.8	6.6	5.8	4.4	4.2	4.2	4.5	4.2	4.0
Below Normal (13%)	3.7	3.9	4.1	4.3	5.2	3.9	3.7	3.9	4.2	4.5	4.2	4.0
Dry (24%)	3.6	3.7	3.9	4.2	4.4	4.2	3.7	3.9	4.1	4.3	4.0	3.8
Critical (15%)	3.6	3.6	3.9	4.0	4.1	3.7	3.6	3.6	3.9	4.1	3.9	3.7

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0
20%	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
30%	0.0	0.0	0.0	0.0	0.0	-0.2	0.0	-0.1	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.1	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-44-1-6. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Maximum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3.9	4.4	7.1	8.2	8.8	7.9	6.3	5.4	4.6	4.5	4.3	4.2
20%	3.8	4.1	5.4	7.3	7.9	6.6	5.0	4.6	4.4	4.5	4.2	4.1
30%	3.8	3.9	4.5	5.7	6.7	5.7	4.2	4.2	4.3	4.5	4.2	4.1
40%	3.7	3.8	4.2	4.7	6.1	4.6	4.0	4.0	4.2	4.4	4.2	4.0
50%	3.7	3.8	4.1	4.4	5.1	4.3	3.8	4.0	4.2	4.4	4.1	3.9
60%	3.6	3.7	4.0	4.2	4.4	4.1	3.8	3.9	4.1	4.3	4.1	3.8
70%	3.6	3.6	3.9	4.1	4.3	3.9	3.7	3.8	4.1	4.2	4.0	3.8
80%	3.5	3.6	3.8	3.9	4.0	3.8	3.5	3.7	4.0	4.2	4.0	3.8
90%	3.4	3.4	3.7	3.8	3.9	3.6	3.4	3.6	3.9	4.1	3.9	3.6
Long Term												
Full Simulation Period ^b	3.7	3.9	4.7	5.3	5.8	5.1	4.3	4.3	4.3	4.3	4.1	3.9
Water Year Types^c												
Wet (32%)	3.8	4.2	5.8	6.9	7.4	6.5	5.3	5.0	4.5	4.4	4.2	4.1
Above Normal (16%)	3.7	4.0	4.7	5.8	6.6	5.8	4.4	4.2	4.2	4.5	4.2	4.0
Below Normal (13%)	3.7	3.9	4.1	4.3	5.2	3.9	3.7	4.0	4.2	4.4	4.2	4.0
Dry (24%)	3.6	3.7	3.9	4.2	4.4	4.2	3.7	3.9	4.1	4.2	4.0	3.8
Critical (15%)	3.6	3.6	3.9	4.0	4.0	3.7	3.6	3.6	3.9	4.1	3.9	3.7

Alternative 5

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4.0	4.5	6.6	8.1	8.7	7.9	6.3	5.4	4.5	4.6	4.3	4.8
20%	3.9	4.3	5.2	6.9	7.8	6.6	5.0	4.5	4.3	4.5	4.3	4.7
30%	3.8	4.2	4.5	5.6	6.6	5.2	4.2	4.1	4.2	4.5	4.3	4.4
40%	3.7	4.0	4.3	4.7	5.9	4.6	4.0	4.0	4.1	4.4	4.2	4.2
50%	3.7	3.9	4.1	4.5	5.1	4.3	3.8	3.9	4.1	4.4	4.1	4.1
60%	3.7	3.8	4.1	4.2	4.4	4.1	3.7	3.8	4.1	4.4	4.1	4.0
70%	3.6	3.7	3.9	4.1	4.2	3.9	3.6	3.7	3.9	4.3	4.1	3.9
80%	3.5	3.6	3.8	4.0	4.1	3.7	3.5	3.6	3.9	4.2	3.9	3.8
90%	3.4	3.5	3.7	3.8	3.9	3.6	3.4	3.5	3.8	4.2	3.9	3.6
Long Term												
Full Simulation Period ^b	3.7	4.0	4.6	5.3	5.7	5.0	4.3	4.2	4.2	4.4	4.1	4.2
Water Year Types^c												
Wet (32%)	3.9	4.4	5.7	6.8	7.3	6.5	5.3	5.0	4.5	4.5	4.2	4.7
Above Normal (16%)	3.7	4.1	4.8	5.8	6.5	5.7	4.4	4.2	4.1	4.5	4.2	4.2
Below Normal (13%)	3.7	4.0	4.2	4.3	5.0	3.9	3.7	3.8	4.1	4.5	4.2	4.0
Dry (24%)	3.6	3.8	3.9	4.2	4.4	4.2	3.7	3.8	4.0	4.3	4.0	3.8
Critical (15%)	3.6	3.6	3.9	4.0	4.1	3.7	3.5	3.5	3.9	4.1	3.9	3.7

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.1	0.0	-0.5	-0.1	0.0	0.0	0.0	0.0	-0.1	0.1	0.1	0.6
20%	0.1	0.2	-0.2	-0.4	0.0	0.0	0.0	0.0	-0.1	0.0	0.1	0.6
30%	0.1	0.2	0.0	-0.2	-0.1	-0.5	0.0	0.0	-0.1	-0.1	0.1	0.3
40%	0.0	0.2	0.0	0.0	-0.2	0.0	0.0	0.0	-0.1	-0.1	0.0	0.2
50%	0.0	0.2	0.1	0.1	0.0	0.0	0.0	-0.1	-0.1	0.0	0.0	0.1
60%	0.0	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.1	0.0	0.1
70%	0.0	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.1	0.1	0.1
80%	0.0	0.0	0.0	0.1	0.1	0.0	-0.1	-0.1	-0.1	0.1	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.1	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.1	0.0	0.2
Water Year Types^c												
Wet (32%)	0.1	0.1	-0.2	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.6
Above Normal (16%)	0.0	0.1	0.1	0.0	-0.1	-0.2	0.0	-0.1	-0.1	0.0	0.0	0.2
Below Normal (13%)	0.0	0.1	0.0	0.0	-0.1	0.0	0.0	-0.2	-0.2	0.0	0.1	0.0
Dry (24%)	0.0	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.1	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	-0.1	0.1	0.0	0.0


^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-44-2-1. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Minimum Elevation, October

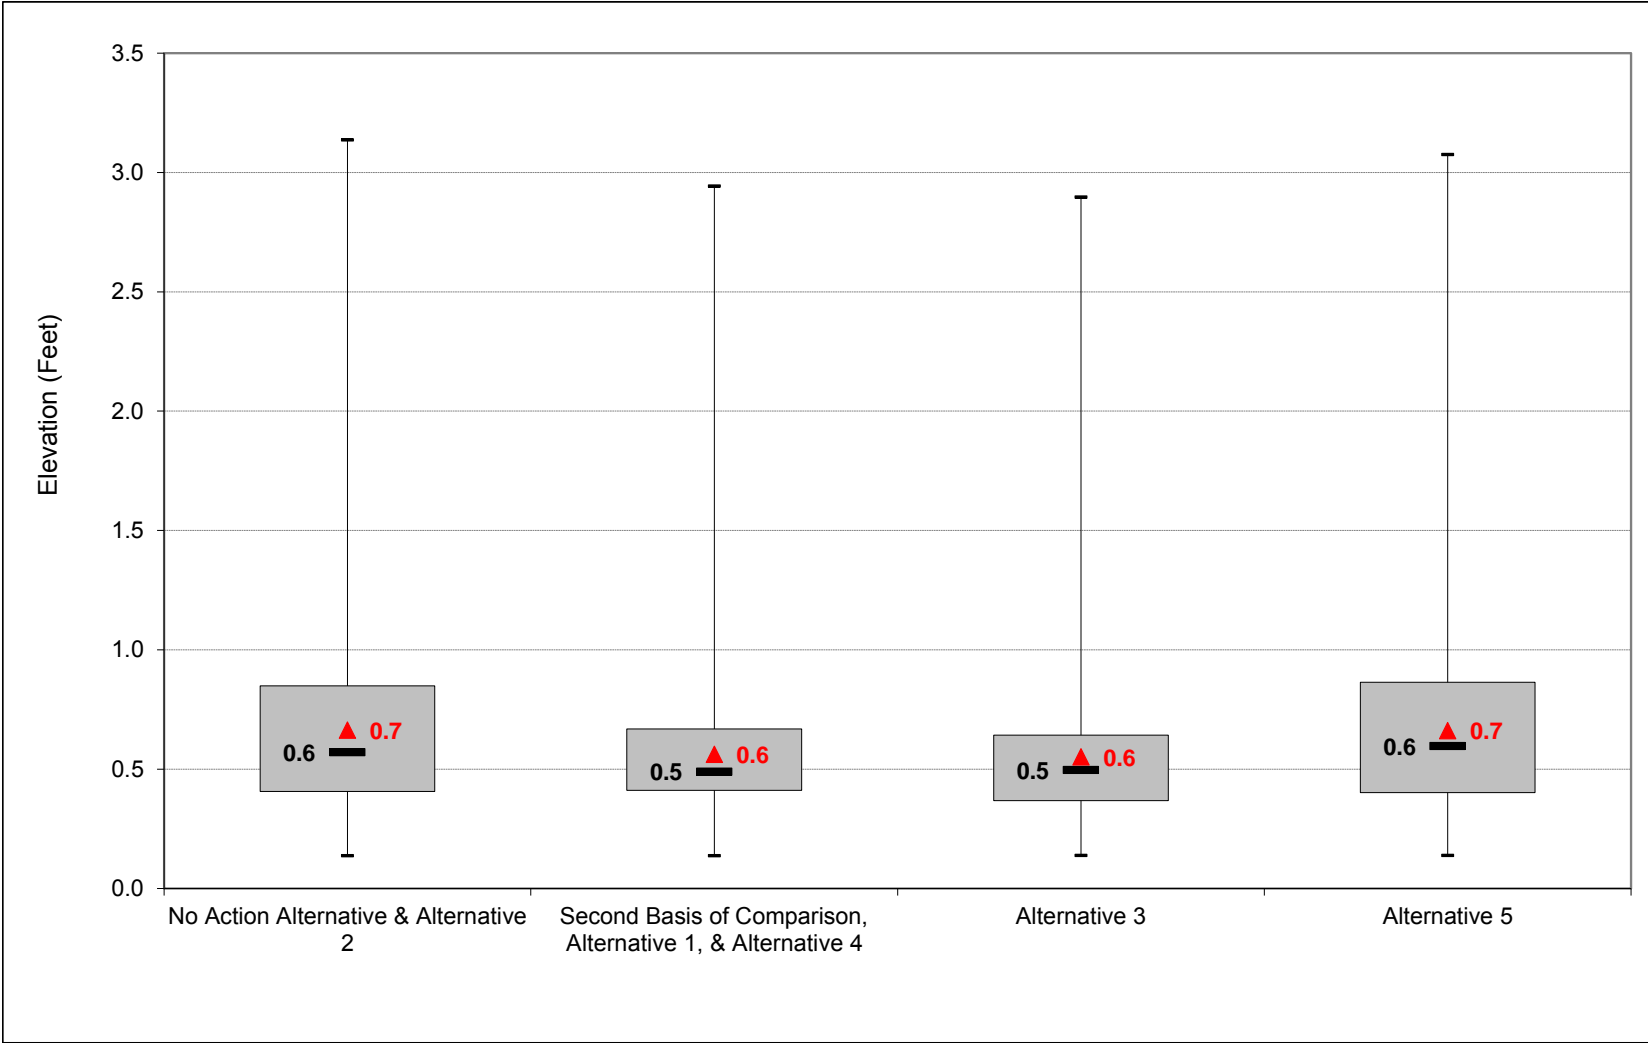


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-44-2-2. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Minimum Elevation, November

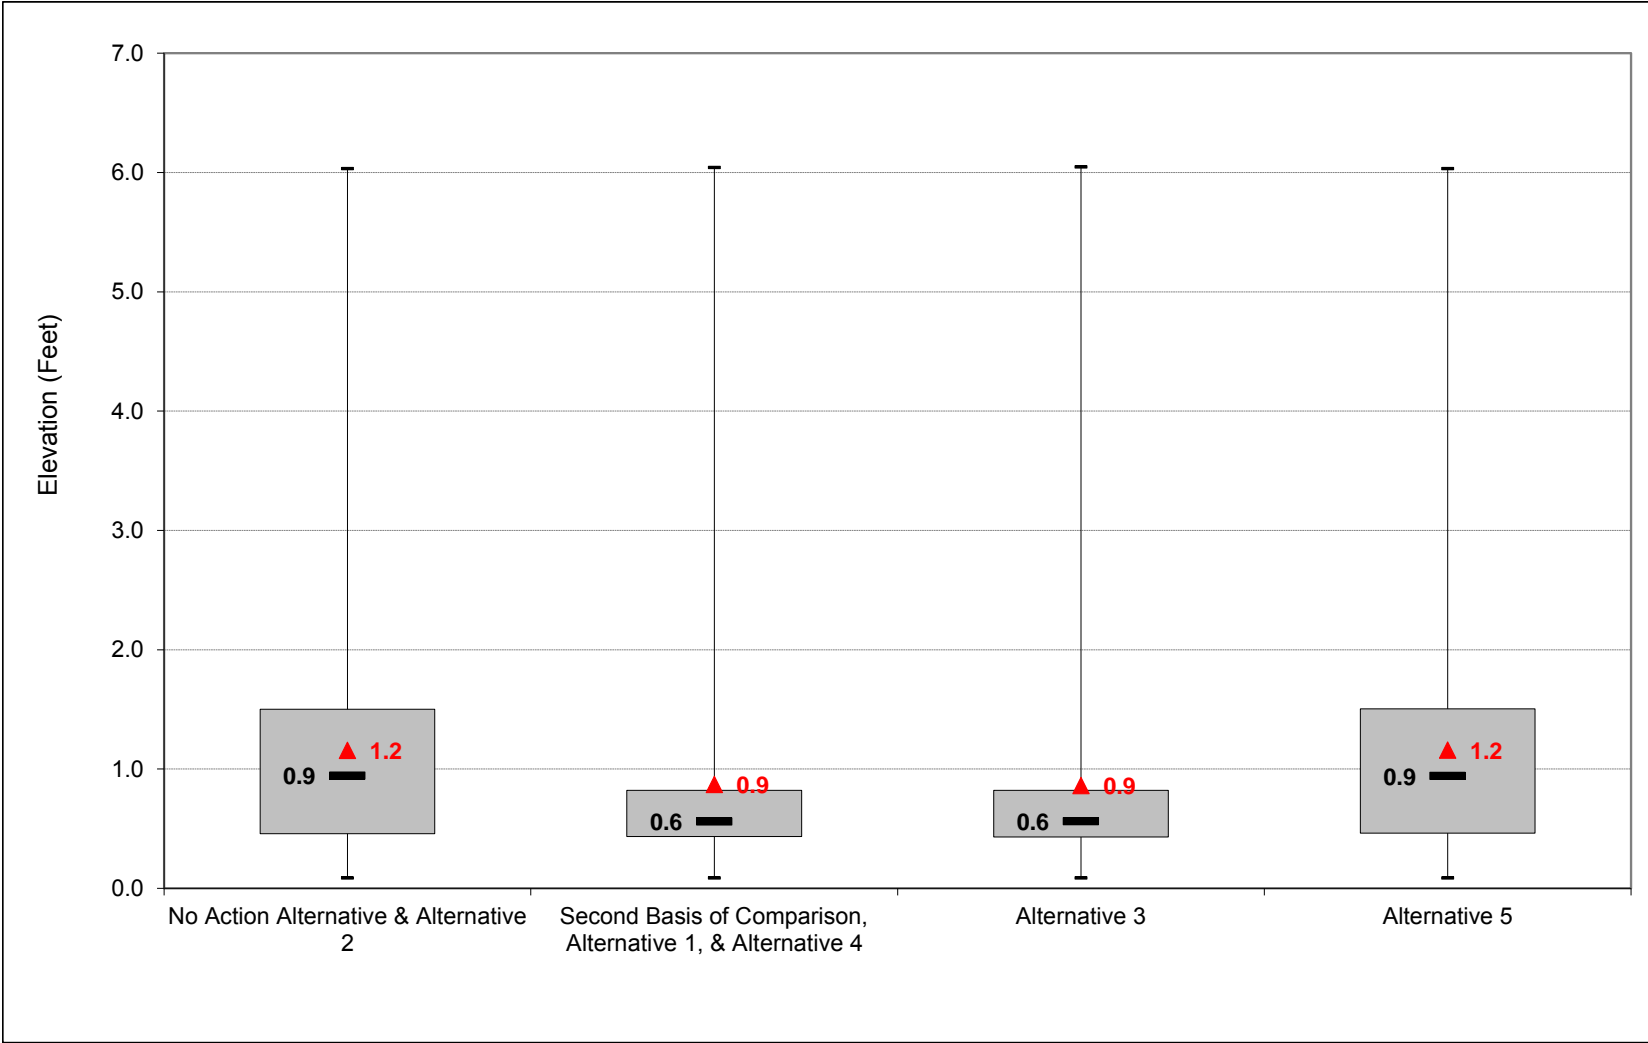


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-44-2-3. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Minimum Elevation, December

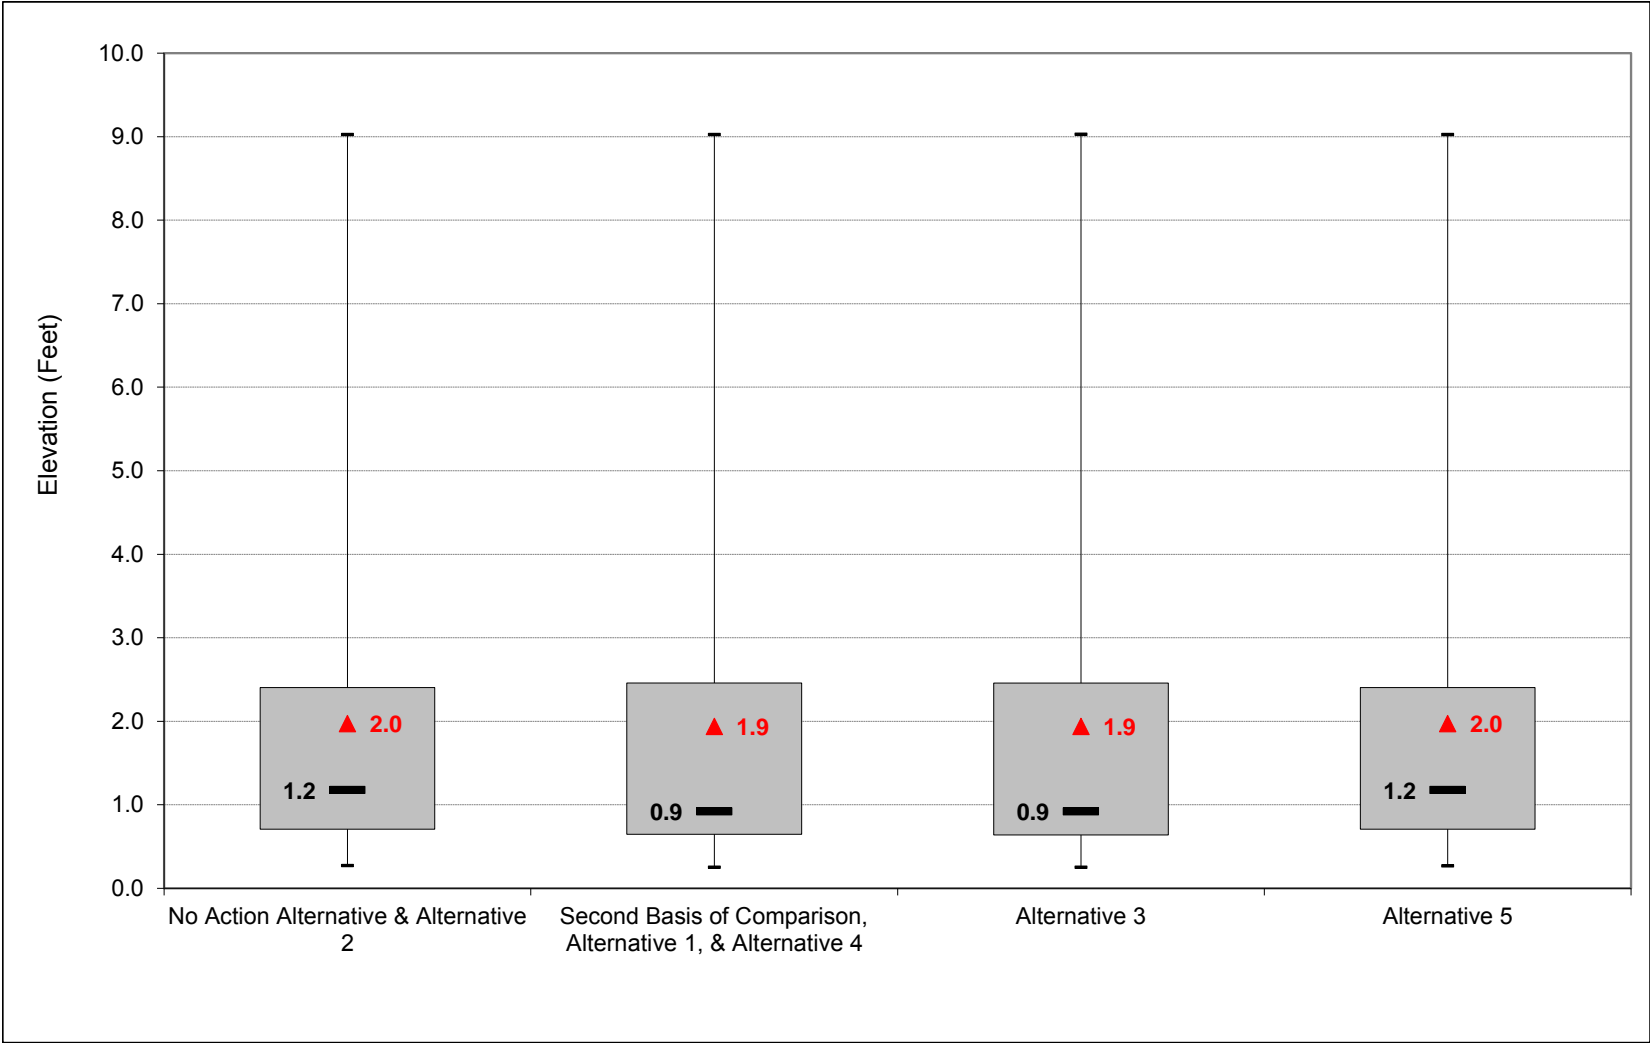


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-44-2-4. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Minimum Elevation, January

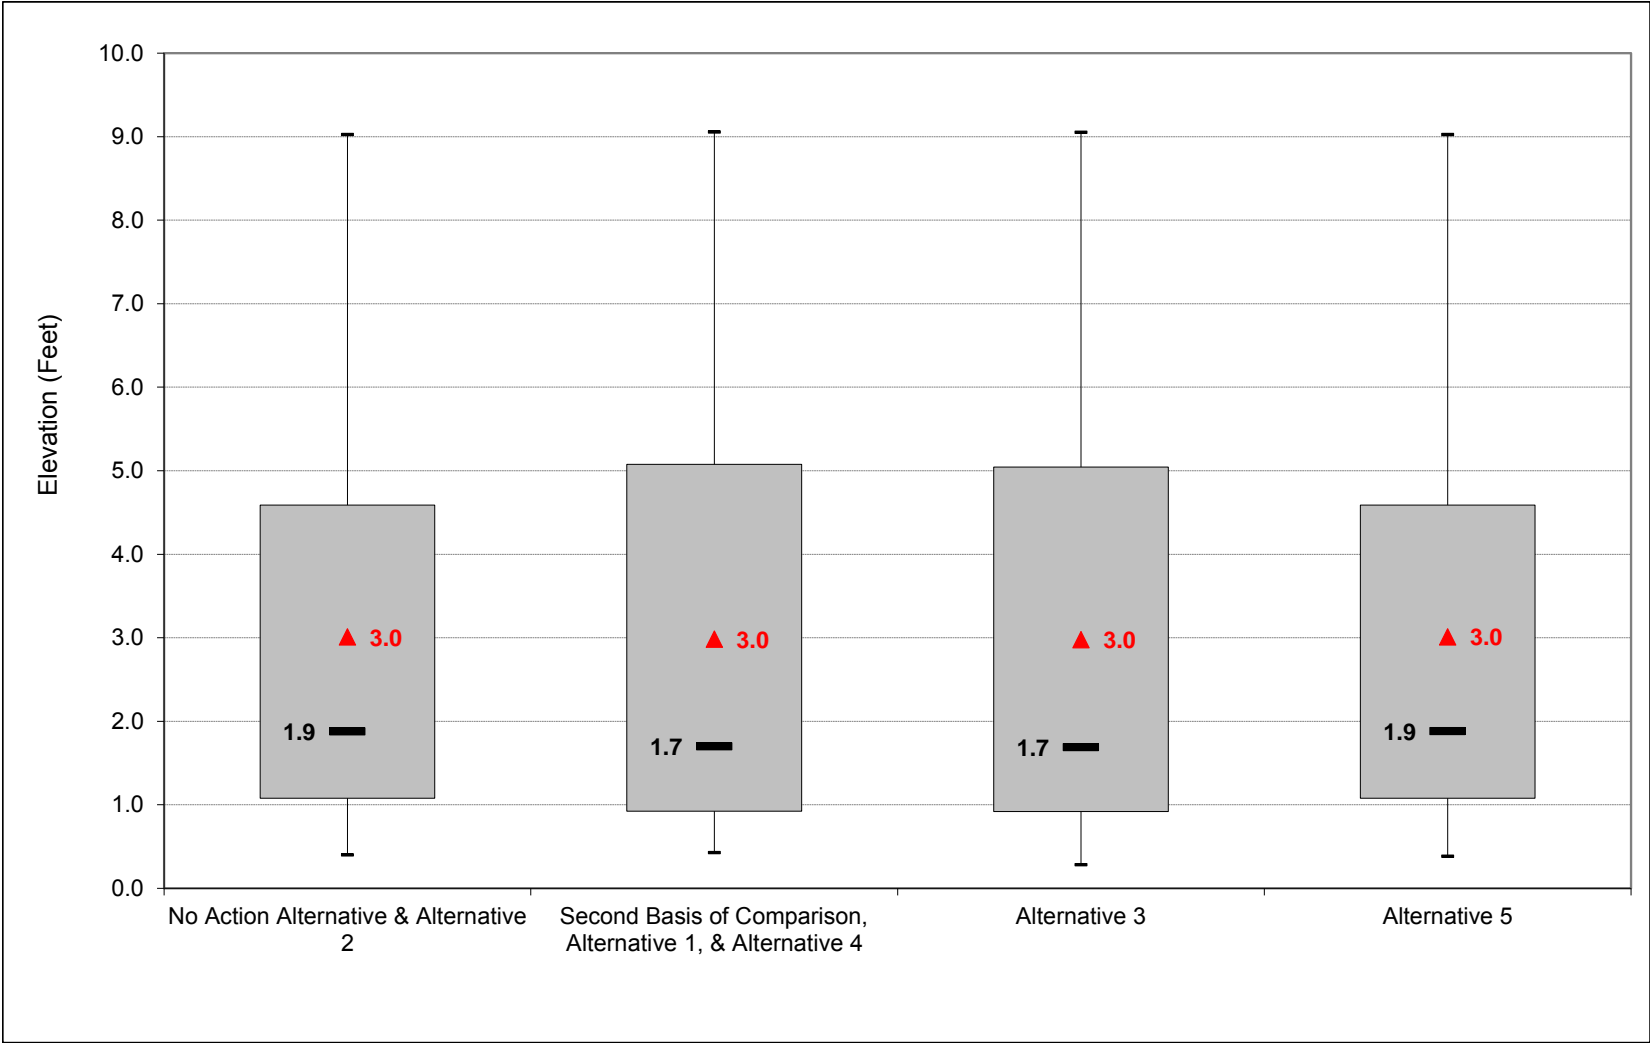


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-44-2-5. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Minimum Elevation, February

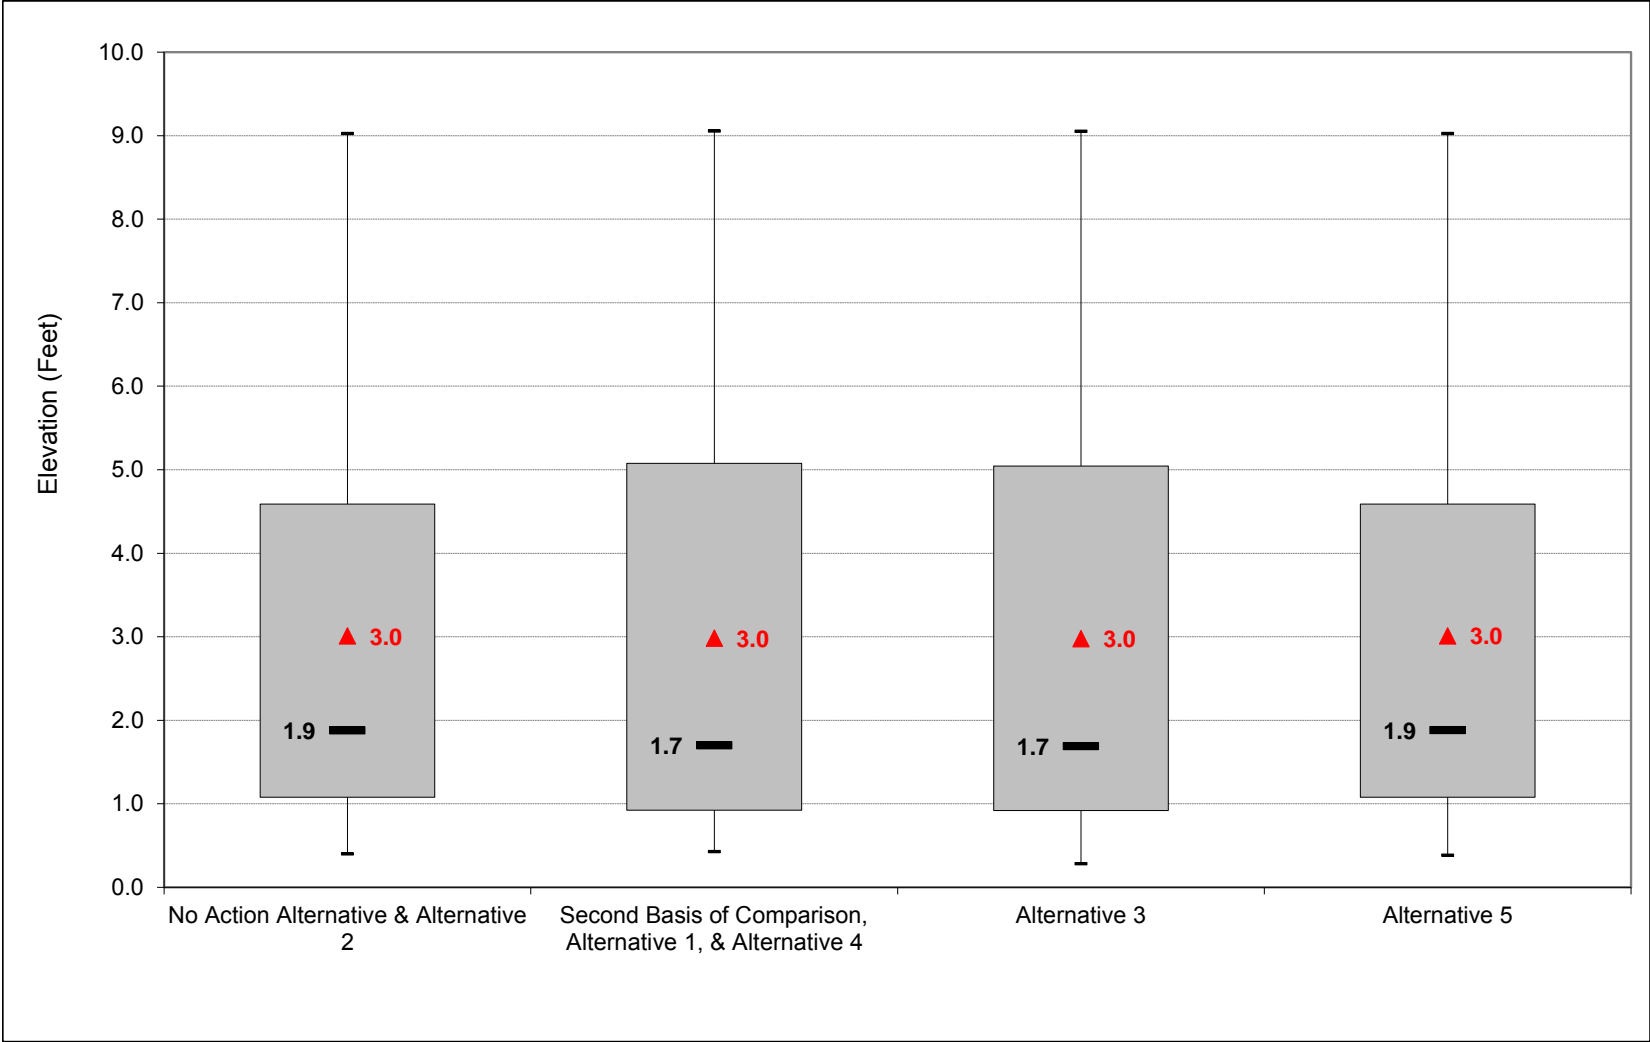


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-44-2-6. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Minimum Elevation, March

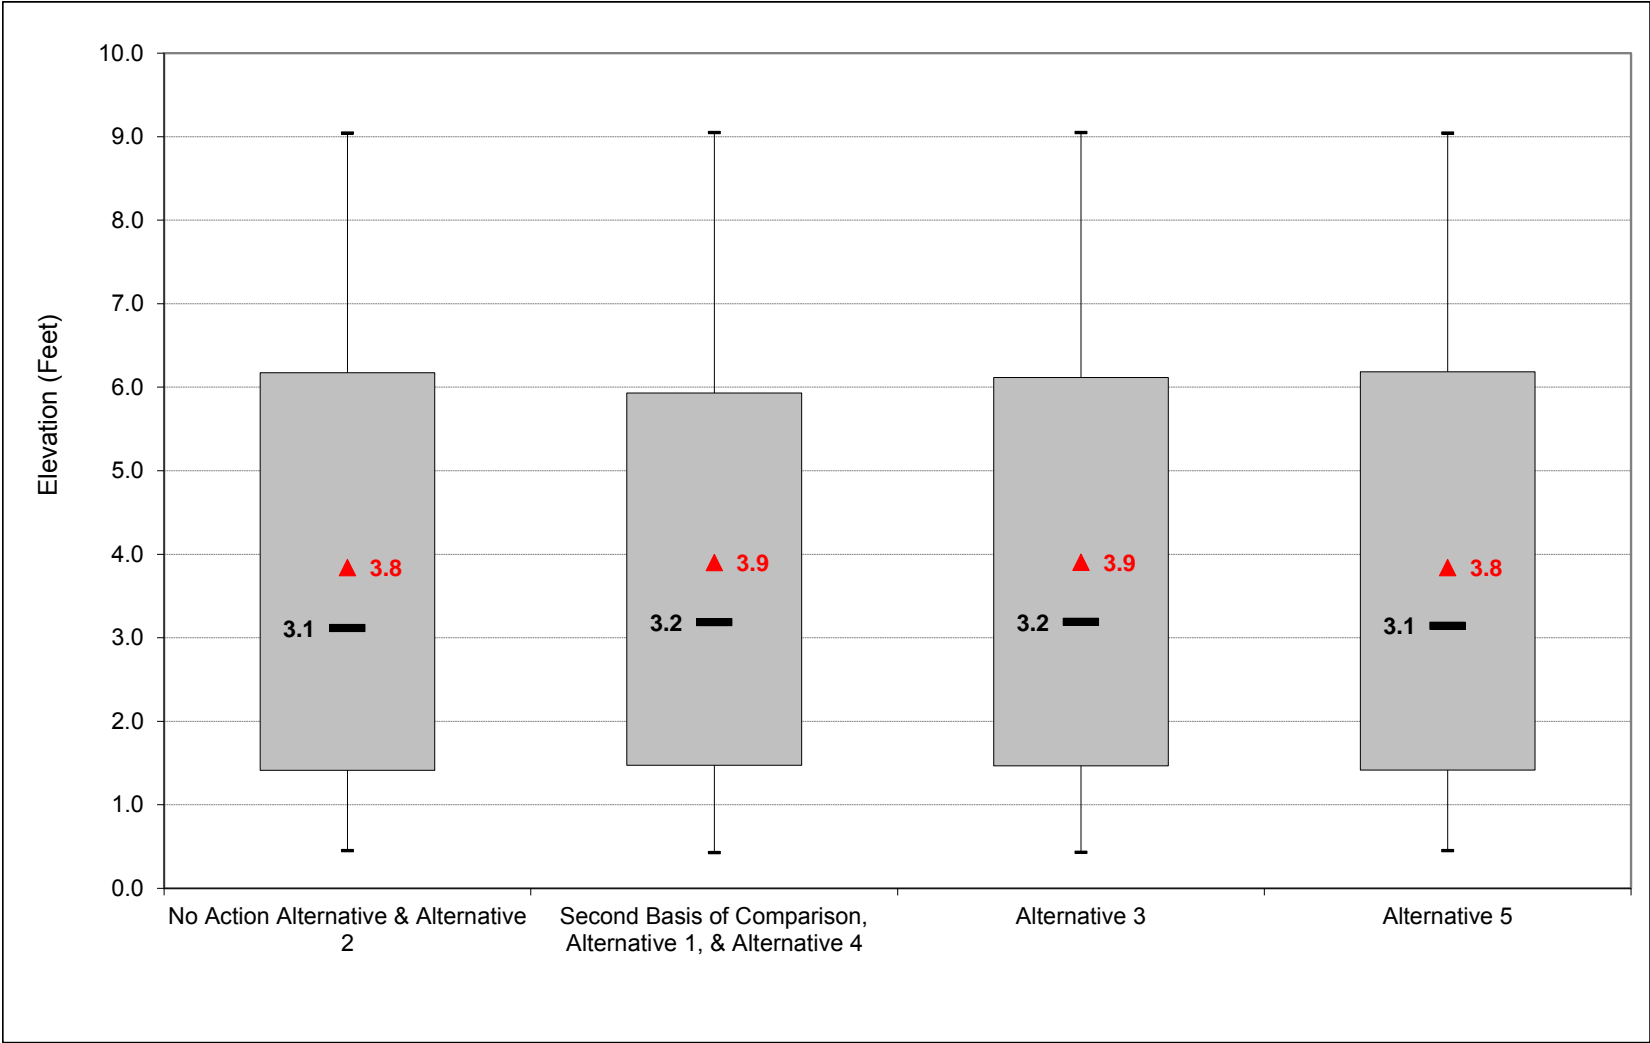


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-44-2-7. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Minimum Elevation, April

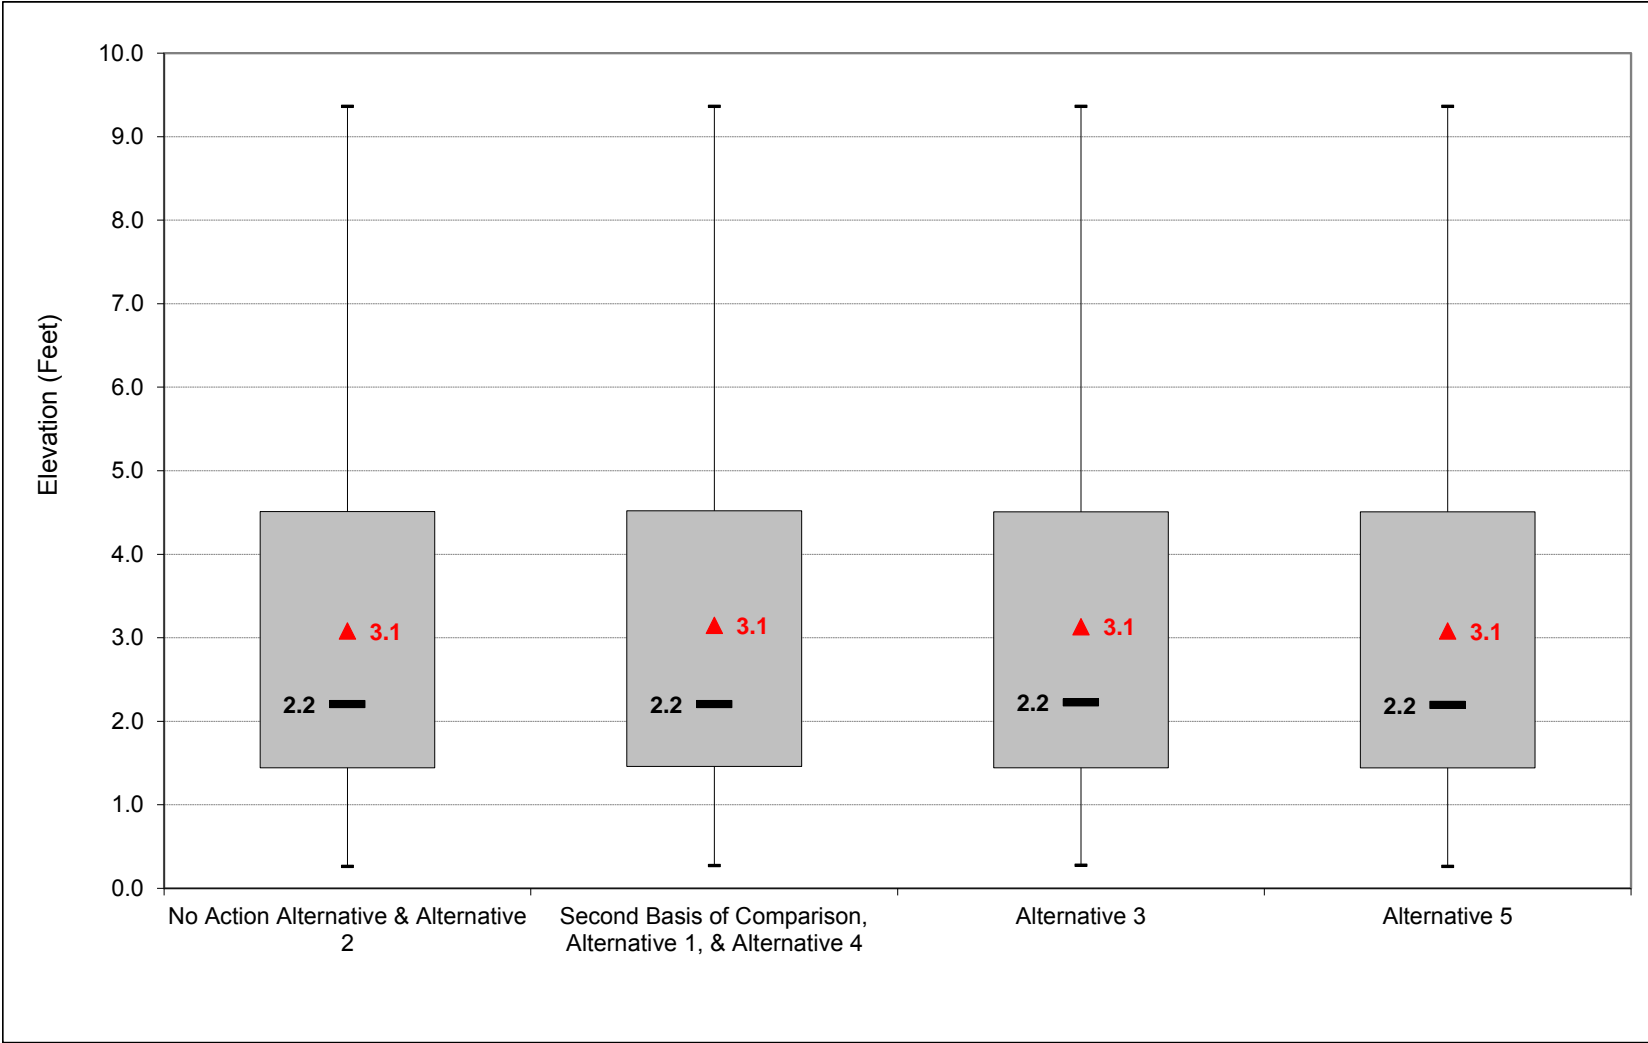


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-44-2-8. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Minimum Elevation, May

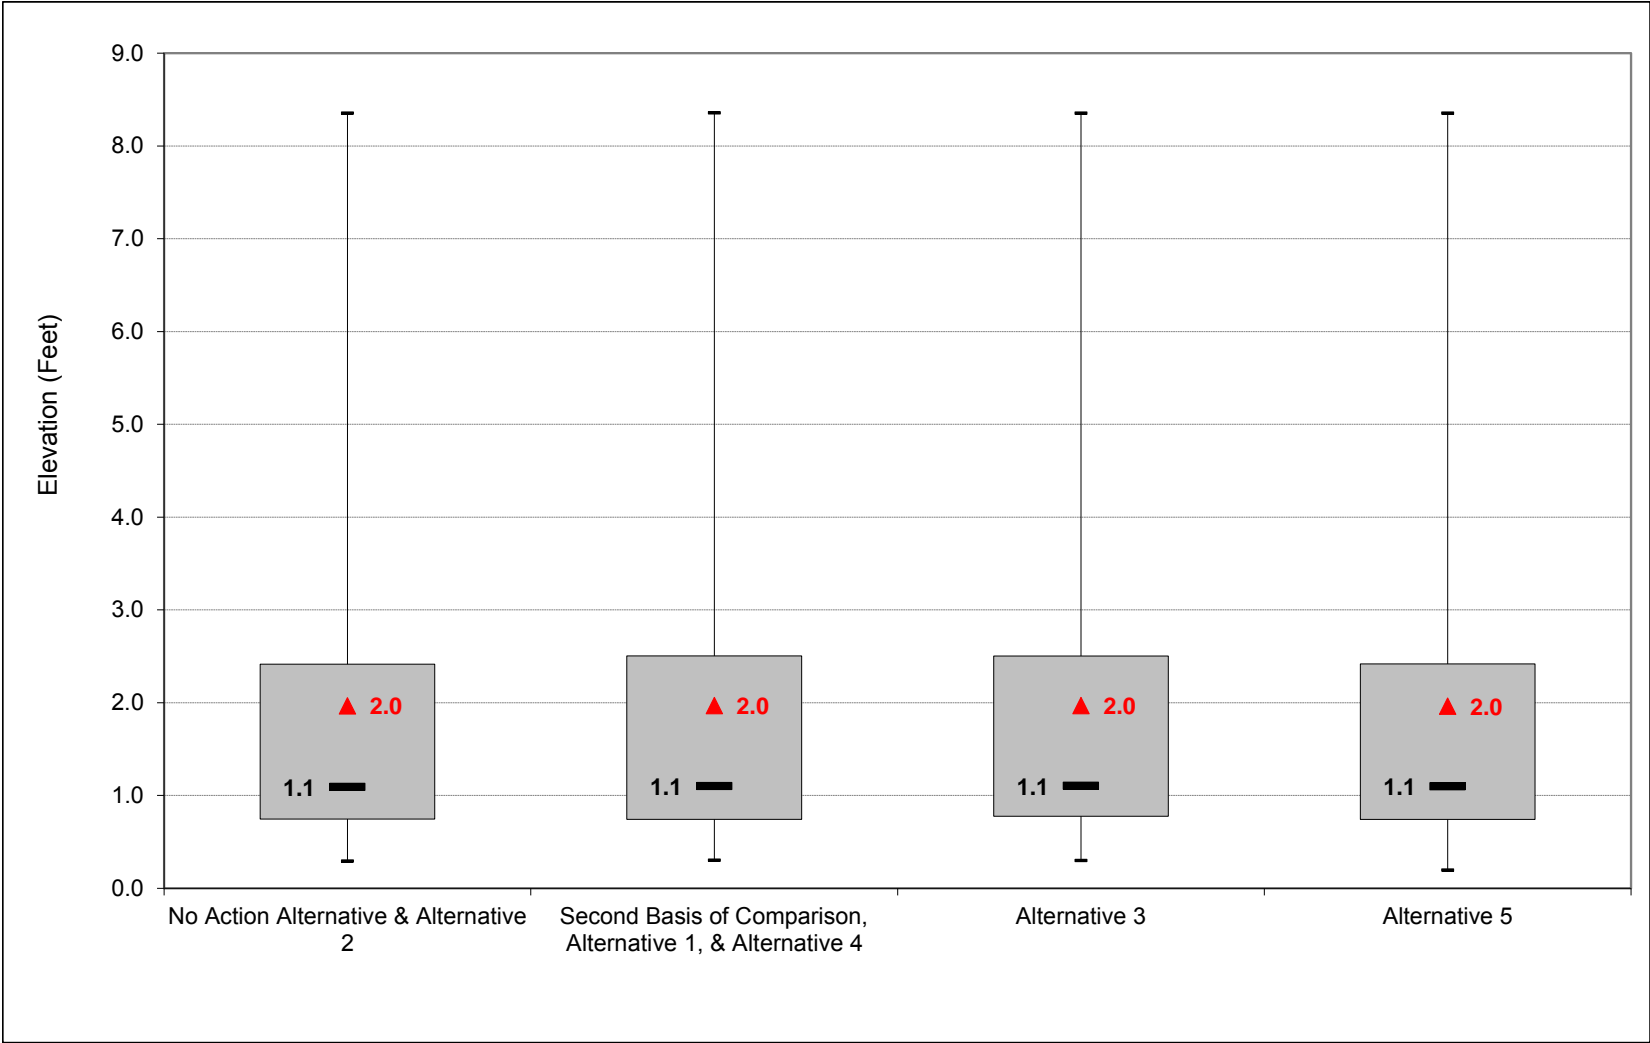


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-44-2-9. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Minimum Elevation, June

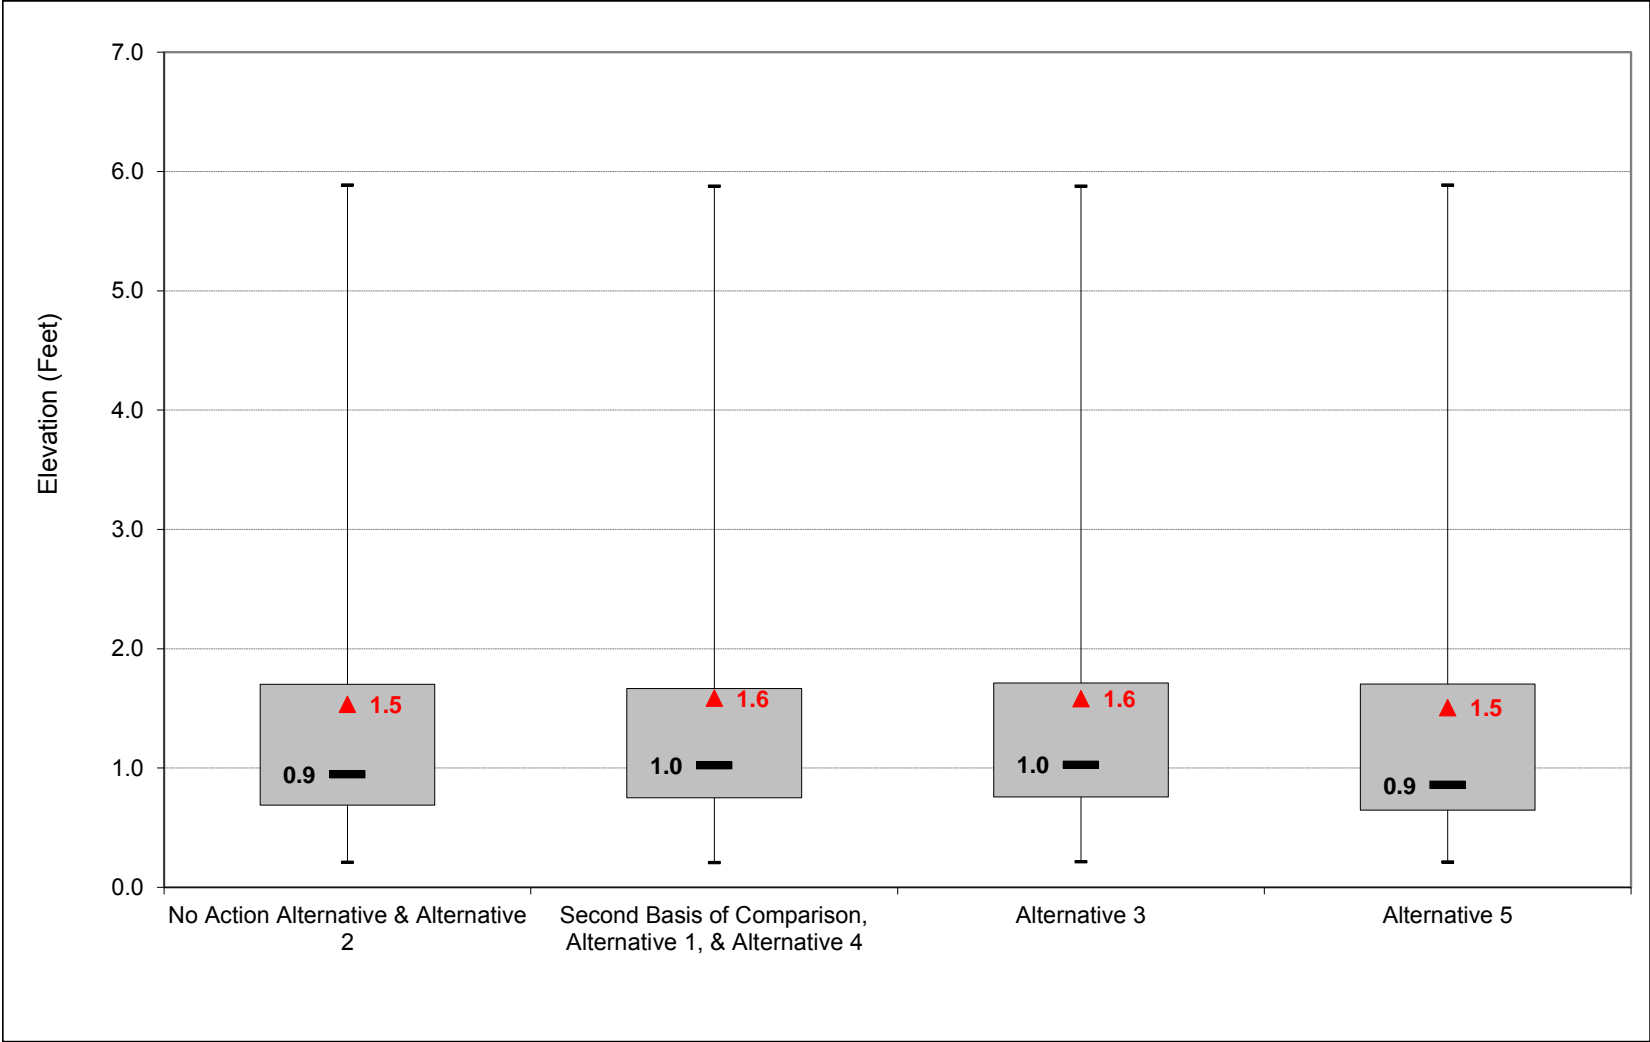


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-44-2-10. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Minimum Elevation, July

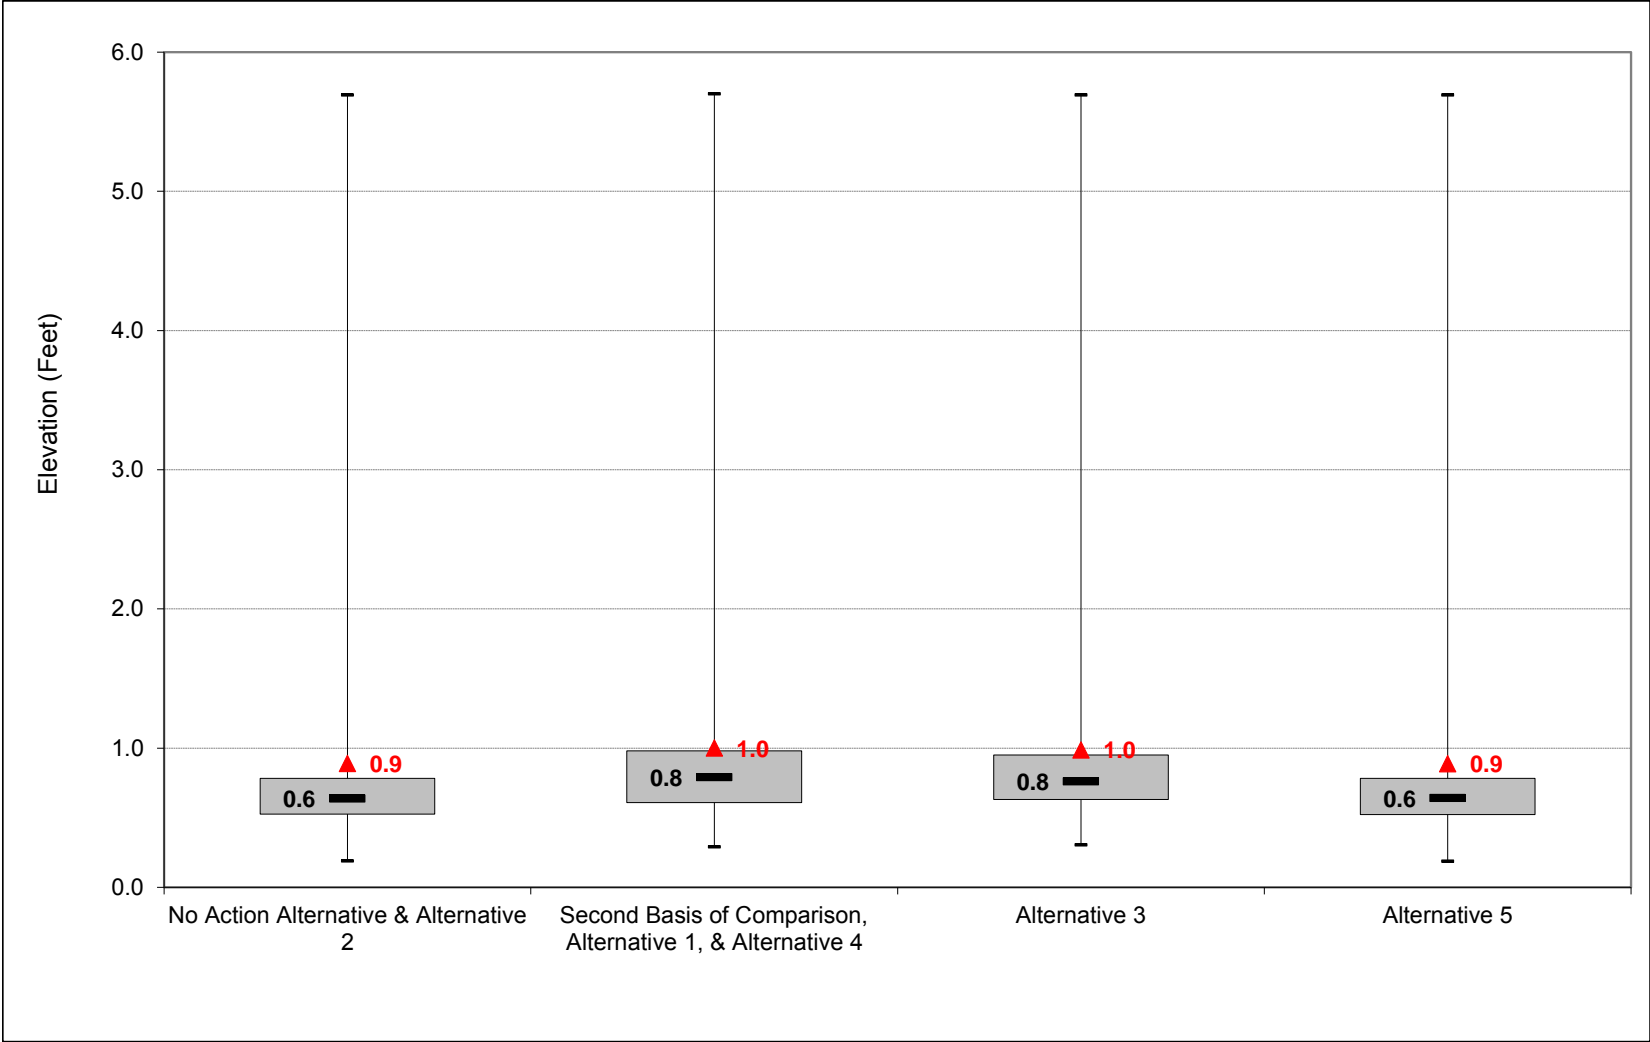


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-44-2-11. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Minimum Elevation, August

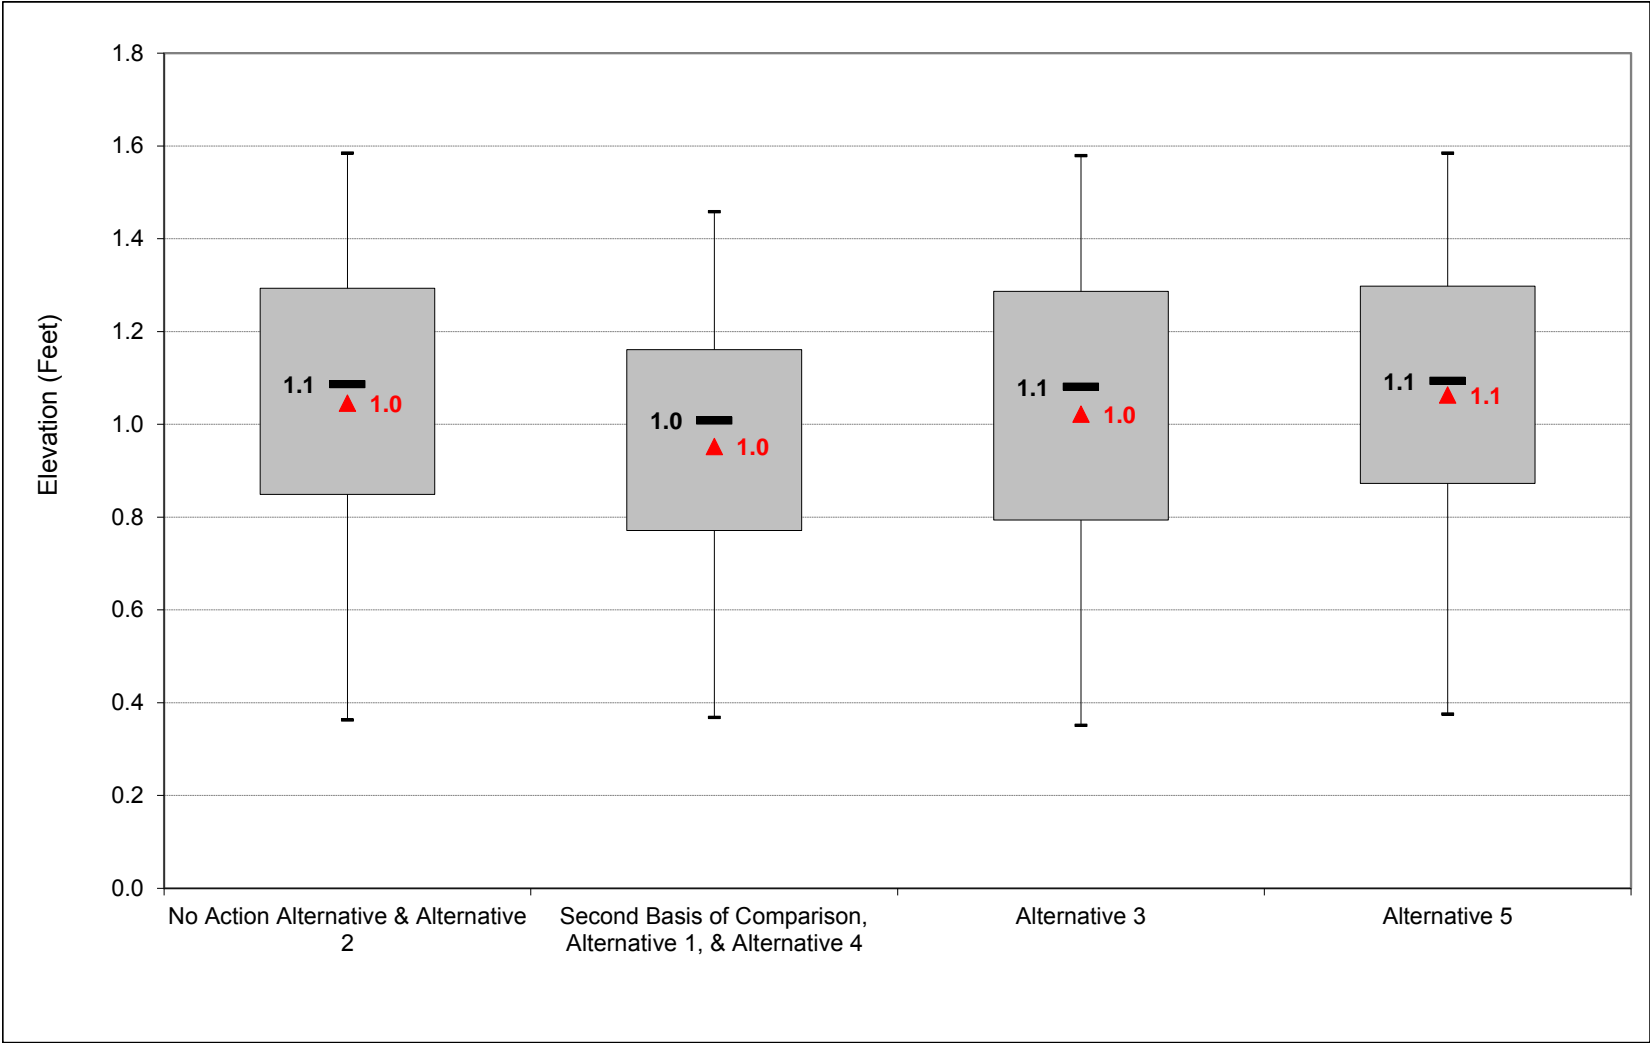

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-44-2-12. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Minimum Elevation, September

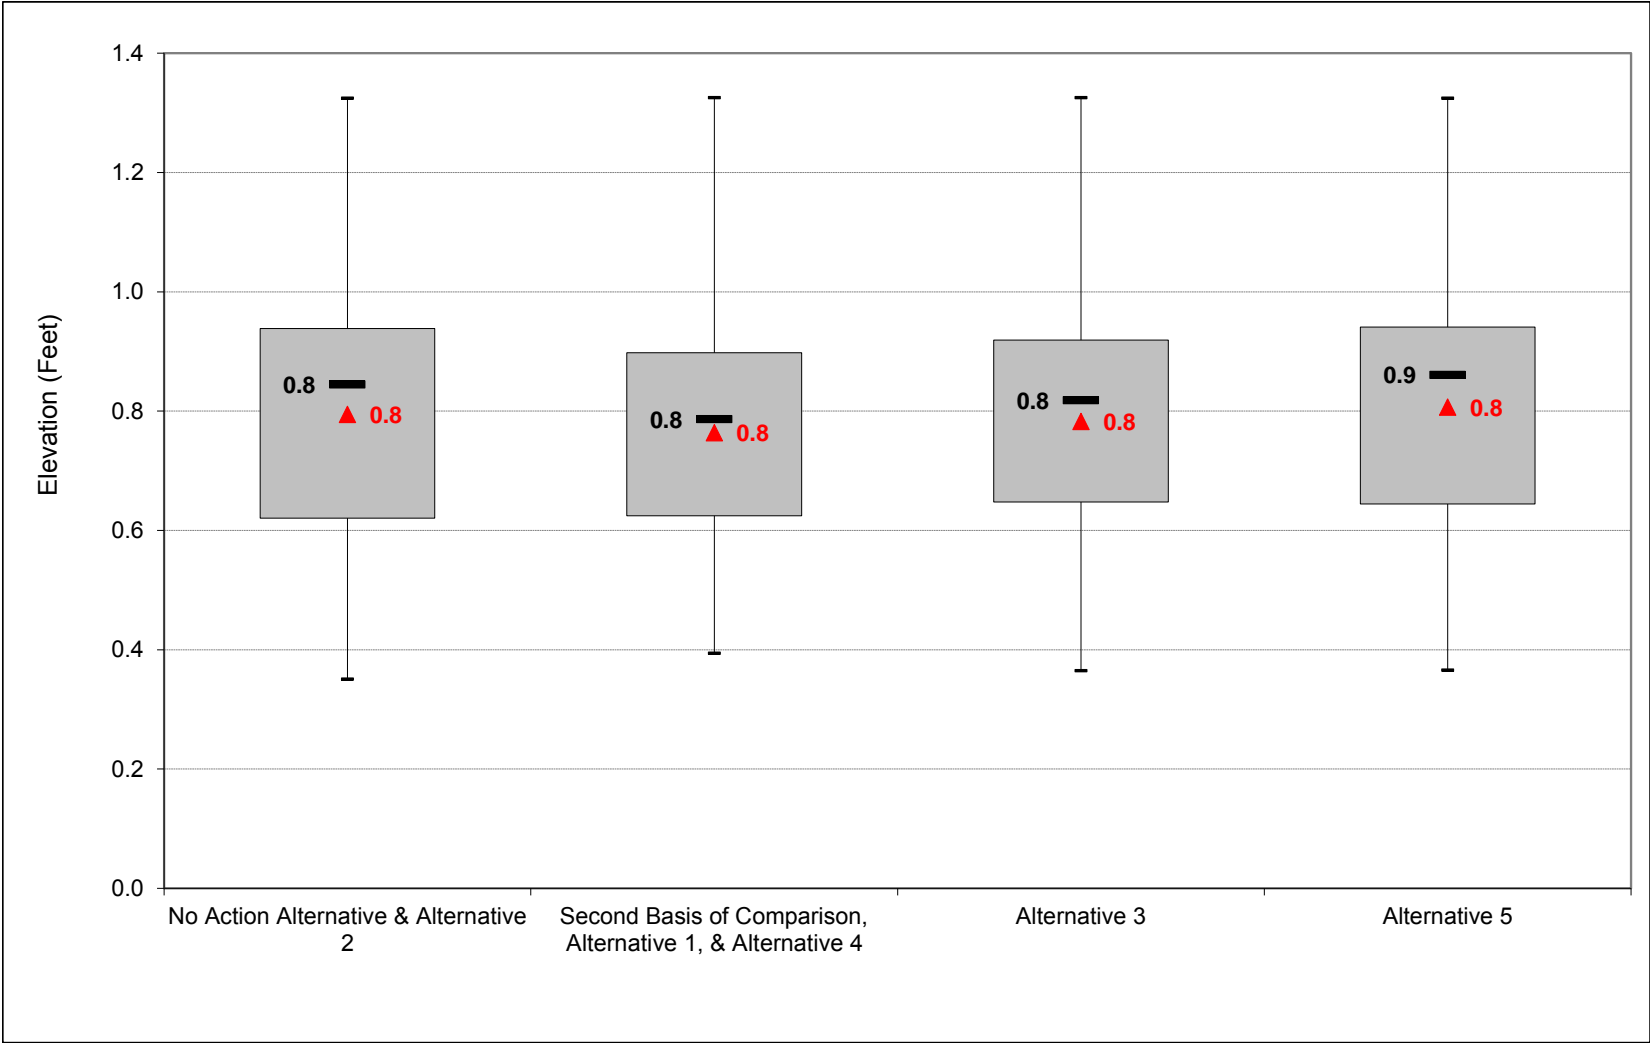

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-44-2-1. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Minimum Elevation

No Action Alternative

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1.1	2.0	5.2	7.0	7.9	6.9	5.0	3.8	1.3	1.4	1.0	2.8
20%	0.9	1.5	3.0	5.6	6.8	5.5	3.3	2.3	0.9	1.3	0.9	2.7
30%	0.8	1.4	1.9	3.8	5.3	3.7	2.0	1.3	0.7	1.3	0.9	1.5
40%	0.7	1.2	1.4	2.4	4.4	2.8	1.6	1.0	0.7	1.2	0.9	1.2
50%	0.6	0.9	1.2	1.9	3.1	2.2	1.1	0.9	0.6	1.1	0.8	0.9
60%	0.5	0.7	1.0	1.4	2.1	1.8	0.9	0.8	0.6	1.0	0.8	0.7
70%	0.4	0.6	0.8	1.1	1.6	1.5	0.8	0.7	0.6	0.9	0.7	0.6
80%	0.4	0.4	0.7	1.0	1.3	1.2	0.7	0.6	0.5	0.8	0.6	0.6
90%	0.3	0.3	0.5	0.8	1.1	0.7	0.6	0.5	0.4	0.6	0.5	0.5
Long Term												
Full Simulation Period ^b	0.7	1.2	2.0	3.0	3.8	3.1	2.0	1.5	0.9	1.0	0.8	1.4
Water Year Types^c												
Wet (32%)	0.9	1.7	3.6	5.3	6.1	5.1	3.5	2.9	1.5	1.2	0.9	2.6
Above Normal (16%)	0.6	1.4	2.2	3.9	5.0	4.2	2.2	1.4	0.7	1.3	1.0	1.2
Below Normal (13%)	0.7	1.1	1.2	1.6	2.9	1.5	1.0	0.9	0.6	1.2	0.9	0.8
Dry (24%)	0.5	0.8	0.9	1.4	2.1	1.9	1.1	0.8	0.6	0.9	0.6	0.6
Critical (15%)	0.4	0.4	0.7	1.1	1.3	0.9	0.7	0.5	0.4	0.6	0.5	0.5

Alternative 1

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.8	1.5	5.8	7.1	7.9	7.0	5.0	3.8	1.3	1.3	1.0	1.0
20%	0.7	0.9	3.3	6.1	6.8	5.5	3.2	2.5	1.0	1.2	0.9	0.9
30%	0.6	0.8	1.6	4.2	5.4	4.2	2.0	1.4	0.9	1.2	0.9	0.9
40%	0.6	0.7	1.2	2.5	4.7	2.9	1.6	1.1	0.9	1.1	0.8	0.8
50%	0.5	0.6	0.9	1.7	3.2	2.2	1.1	1.0	0.8	1.0	0.8	0.8
60%	0.5	0.5	0.9	1.2	2.2	1.8	0.9	0.9	0.7	0.9	0.7	0.7
70%	0.4	0.5	0.7	1.0	1.7	1.5	0.8	0.8	0.6	0.8	0.7	0.6
80%	0.4	0.4	0.6	0.9	1.3	1.2	0.7	0.7	0.6	0.6	0.6	0.5
90%	0.3	0.2	0.5	0.7	1.1	0.7	0.6	0.6	0.4	0.5	0.5	0.5
Long Term												
Full Simulation Period ^b	0.6	0.9	1.9	3.0	3.9	3.1	2.0	1.6	1.0	1.0	0.8	0.8
Water Year Types^c												
Wet (32%)	0.7	1.3	3.8	5.4	6.2	5.2	3.5	2.9	1.6	1.1	0.9	0.9
Above Normal (16%)	0.5	1.0	2.0	4.0	5.1	4.4	2.2	1.5	0.9	1.2	0.9	0.8
Below Normal (13%)	0.6	0.8	1.0	1.5	3.1	1.6	1.1	1.1	0.9	1.1	0.8	0.8
Dry (24%)	0.5	0.5	0.8	1.2	2.1	1.9	1.1	0.9	0.7	0.7	0.6	0.6
Critical (15%)	0.4	0.4	0.6	1.0	1.3	1.0	0.7	0.5	0.5	0.5	0.5	0.5

Alternative 1 minus No Action Alternative

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-0.2	-0.5	0.6	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	-1.8
20%	-0.2	-0.7	0.3	0.4	0.0	0.0	0.0	0.3	0.1	-0.1	0.0	-1.8
30%	-0.2	-0.6	-0.3	0.3	0.2	0.6	0.0	0.1	0.2	-0.1	-0.1	-0.6
40%	-0.1	-0.5	-0.3	0.1	0.3	0.1	0.0	0.1	0.2	-0.1	-0.1	-0.4
50%	-0.1	-0.4	-0.3	-0.2	0.1	0.0	0.0	0.1	0.2	-0.1	-0.1	-0.1
60%	0.0	-0.2	-0.1	-0.2	0.0	0.0	0.0	0.1	0.1	-0.1	-0.1	0.0
70%	0.0	-0.1	-0.1	-0.2	0.1	0.0	0.0	0.1	0.1	-0.1	0.0	0.0
80%	0.0	-0.1	-0.1	-0.2	0.0	0.0	0.0	0.1	0.1	-0.2	0.0	0.0
90%	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.1	-0.1	0.0	0.0
Long Term												
Full Simulation Period ^b	-0.1	-0.3	0.0	0.0	0.1	0.1	0.0	0.1	0.1	-0.1	0.0	-0.6
Water Year Types^c												
Wet (32%)	-0.2	-0.3	0.2	0.1	0.1	0.1	0.0	0.0	0.0	-0.1	0.0	-1.7
Above Normal (16%)	-0.1	-0.4	-0.2	0.1	0.1	0.2	0.0	0.1	0.2	-0.1	0.0	-0.4
Below Normal (13%)	-0.1	-0.3	-0.1	-0.1	0.2	0.1	0.0	0.2	0.3	-0.1	-0.1	0.0
Dry (24%)	0.0	-0.3	-0.1	-0.2	0.0	0.0	0.0	0.1	0.1	-0.1	0.0	0.0
Critical (15%)	0.0	0.0	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-44-2.2. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Minimum Elevation

No Action Alternative												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1.1	2.0	5.2	7.0	7.9	6.9	5.0	3.8	1.3	1.4	1.0	2.8
20%	0.9	1.5	3.0	5.6	6.8	5.5	3.3	2.3	0.9	1.3	0.9	2.7
30%	0.8	1.4	1.9	3.8	5.3	3.7	2.0	1.3	0.7	1.3	0.9	1.5
40%	0.7	1.2	1.4	2.4	4.4	2.8	1.6	1.0	0.7	1.2	0.9	1.2
50%	0.6	0.9	1.2	1.9	3.1	2.2	1.1	0.9	0.6	1.1	0.8	0.9
60%	0.5	0.7	1.0	1.4	2.1	1.8	0.9	0.8	0.6	1.0	0.8	0.7
70%	0.4	0.6	0.8	1.1	1.6	1.5	0.8	0.7	0.6	0.9	0.7	0.6
80%	0.4	0.4	0.7	1.0	1.3	1.2	0.7	0.6	0.5	0.8	0.6	0.6
90%	0.3	0.3	0.5	0.8	1.1	0.7	0.6	0.5	0.4	0.6	0.5	0.5
Long Term												
Full Simulation Period ^b	0.7	1.2	2.0	3.0	3.8	3.1	2.0	1.5	0.9	1.0	0.8	1.4
Water Year Types^c												
Wet (32%)	0.9	1.7	3.6	5.3	6.1	5.1	3.5	2.9	1.5	1.2	0.9	2.6
Above Normal (16%)	0.6	1.4	2.2	3.9	5.0	4.2	2.2	1.4	0.7	1.3	1.0	1.2
Below Normal (13%)	0.7	1.1	1.2	1.6	2.9	1.5	1.0	0.9	0.6	1.2	0.9	0.8
Dry (24%)	0.5	0.8	0.9	1.4	2.1	1.9	1.1	0.8	0.6	0.9	0.6	0.6
Critical (15%)	0.4	0.4	0.7	1.1	1.3	0.9	0.7	0.5	0.4	0.6	0.5	0.5

Alternative 3												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.8	1.5	5.7	7.1	7.9	7.0	5.0	3.8	1.2	1.4	1.0	1.0
20%	0.7	0.9	3.4	6.0	6.8	5.5	3.2	2.3	1.0	1.3	0.9	0.9
30%	0.6	0.8	1.6	4.2	5.5	3.9	2.0	1.5	0.9	1.3	0.9	0.9
40%	0.6	0.6	1.2	2.5	4.7	2.9	1.6	1.1	0.8	1.2	0.9	0.8
50%	0.5	0.6	0.9	1.7	3.2	2.2	1.1	1.0	0.8	1.1	0.8	0.8
60%	0.5	0.5	0.8	1.3	2.2	1.8	0.9	0.9	0.7	1.0	0.8	0.7
70%	0.4	0.4	0.7	1.0	1.7	1.5	0.8	0.8	0.7	0.8	0.7	0.6
80%	0.3	0.3	0.6	0.9	1.3	1.2	0.7	0.7	0.6	0.7	0.6	0.6
90%	0.3	0.2	0.4	0.7	1.1	0.7	0.6	0.5	0.4	0.6	0.5	0.5
Long Term												
Full Simulation Period ^b	0.6	0.9	1.9	3.0	3.9	3.1	2.0	1.6	1.0	1.0	0.8	0.8
Water Year Types^c												
Wet (32%)	0.7	1.3	3.8	5.4	6.2	5.1	3.5	2.9	1.6	1.2	0.9	0.9
Above Normal (16%)	0.5	1.0	2.0	3.9	5.1	4.3	2.2	1.5	0.8	1.3	0.9	0.8
Below Normal (13%)	0.6	0.7	1.1	1.5	3.1	1.6	1.1	1.0	0.8	1.3	0.9	0.8
Dry (24%)	0.5	0.5	0.8	1.3	2.1	1.9	1.1	0.9	0.7	0.8	0.6	0.6
Critical (15%)	0.4	0.4	0.6	0.9	1.3	0.9	0.7	0.5	0.5	0.5	0.5	0.5

Alternative 3 minus No Action Alternative												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-0.2	-0.4	0.6	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-1.8
20%	-0.2	-0.7	0.4	0.4	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-1.8
30%	-0.2	-0.6	-0.3	0.3	0.2	0.3	0.0	0.1	0.2	0.0	0.0	-0.6
40%	-0.1	-0.5	-0.2	0.1	0.3	0.1	0.0	0.1	0.1	0.0	0.0	-0.4
50%	-0.1	-0.4	-0.3	-0.2	0.1	0.0	0.0	0.1	0.1	0.0	0.0	-0.1
60%	0.0	-0.2	-0.1	-0.2	0.1	0.0	0.0	0.1	0.1	0.0	0.0	0.0
70%	0.0	-0.1	-0.1	-0.2	0.1	0.0	0.0	0.1	0.1	0.0	0.0	0.0
80%	0.0	-0.1	-0.1	-0.2	0.0	0.0	0.0	0.1	0.1	-0.1	0.1	0.0
90%	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	-0.1	-0.3	0.0	0.0	0.1	0.1	0.0	0.0	0.1	0.0	0.0	-0.6
Water Year Types^c												
Wet (32%)	-0.2	-0.3	0.2	0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-1.7
Above Normal (16%)	-0.1	-0.4	-0.2	0.0	0.1	0.2	0.0	0.1	0.1	0.0	0.0	-0.4
Below Normal (13%)	-0.2	-0.4	-0.1	0.0	0.2	0.1	0.0	0.1	0.1	0.0	0.0	0.0
Dry (24%)	0.0	-0.3	-0.1	-0.2	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0
Critical (15%)	0.0	-0.1	-0.1	-0.2	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-44-2.3. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Minimum Elevation

No Action Alternative

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1.1	2.0	5.2	7.0	7.9	6.9	5.0	3.8	1.3	1.4	1.0	2.8
20%	0.9	1.5	3.0	5.6	6.8	5.5	3.3	2.3	0.9	1.3	0.9	2.7
30%	0.8	1.4	1.9	3.8	5.3	3.7	2.0	1.3	0.7	1.3	0.9	1.5
40%	0.7	1.2	1.4	2.4	4.4	2.8	1.6	1.0	0.7	1.2	0.9	1.2
50%	0.6	0.9	1.2	1.9	3.1	2.2	1.1	0.9	0.6	1.1	0.8	0.9
60%	0.5	0.7	1.0	1.4	2.1	1.8	0.9	0.8	0.6	1.0	0.8	0.7
70%	0.4	0.6	0.8	1.1	1.6	1.5	0.8	0.7	0.6	0.9	0.7	0.6
80%	0.4	0.4	0.7	1.0	1.3	1.2	0.7	0.6	0.5	0.8	0.6	0.6
90%	0.3	0.3	0.5	0.8	1.1	0.7	0.6	0.5	0.4	0.6	0.5	0.5
Long Term												
Full Simulation Period ^b	0.7	1.2	2.0	3.0	3.8	3.1	2.0	1.5	0.9	1.0	0.8	1.4
Water Year Types^c												
Wet (32%)	0.9	1.7	3.6	5.3	6.1	5.1	3.5	2.9	1.5	1.2	0.9	2.6
Above Normal (16%)	0.6	1.4	2.2	3.9	5.0	4.2	2.2	1.4	0.7	1.3	1.0	1.2
Below Normal (13%)	0.7	1.1	1.2	1.6	2.9	1.5	1.0	0.9	0.6	1.2	0.9	0.8
Dry (24%)	0.5	0.8	0.9	1.4	2.1	1.9	1.1	0.8	0.6	0.9	0.6	0.6
Critical (15%)	0.4	0.4	0.7	1.1	1.3	0.9	0.7	0.5	0.4	0.6	0.5	0.5

Alternative 5

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1.1	2.0	5.2	7.0	7.9	6.9	5.0	3.8	1.3	1.4	1.0	2.8
20%	0.9	1.5	3.0	5.6	6.8	5.5	3.3	2.3	0.9	1.3	1.0	2.7
30%	0.8	1.4	1.9	3.8	5.3	3.7	2.0	1.3	0.8	1.3	0.9	1.5
40%	0.7	1.2	1.4	2.3	4.4	2.8	1.6	1.0	0.7	1.2	0.9	1.2
50%	0.6	0.9	1.2	1.9	3.1	2.2	1.1	0.9	0.6	1.1	0.9	0.9
60%	0.5	0.7	1.0	1.4	2.1	1.8	0.9	0.8	0.6	1.0	0.8	0.8
70%	0.4	0.6	0.8	1.1	1.6	1.5	0.8	0.7	0.6	0.9	0.7	0.6
80%	0.4	0.4	0.7	1.0	1.3	1.2	0.7	0.6	0.5	0.8	0.6	0.6
90%	0.3	0.3	0.5	0.8	1.1	0.7	0.5	0.5	0.4	0.6	0.5	0.5
Long Term												
Full Simulation Period ^b	0.7	1.2	2.0	3.0	3.8	3.1	2.0	1.5	0.9	1.1	0.8	1.3
Water Year Types^c												
Wet (32%)	0.9	1.7	3.6	5.3	6.1	5.1	3.5	2.9	1.5	1.2	0.9	2.6
Above Normal (16%)	0.6	1.4	2.2	3.9	5.0	4.2	2.2	1.4	0.7	1.3	1.0	1.2
Below Normal (13%)	0.7	1.1	1.2	1.6	2.9	1.5	1.0	0.9	0.6	1.2	0.9	0.8
Dry (24%)	0.5	0.8	0.9	1.4	2.1	1.9	1.1	0.8	0.6	0.9	0.6	0.6
Critical (15%)	0.4	0.4	0.7	1.1	1.3	0.9	0.6	0.5	0.4	0.6	0.5	0.5

Alternative 5 minus No Action Alternative

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
30%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-44-2-4. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Minimum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.8	1.5	5.8	7.1	7.9	7.0	5.0	3.8	1.3	1.3	1.0	1.0
20%	0.7	0.9	3.3	6.1	6.8	5.5	3.2	2.5	1.0	1.2	0.9	0.9
30%	0.6	0.8	1.6	4.2	5.4	4.2	2.0	1.4	0.9	1.2	0.9	0.9
40%	0.6	0.7	1.2	2.5	4.7	2.9	1.6	1.1	0.9	1.1	0.8	0.8
50%	0.5	0.6	0.9	1.7	3.2	2.2	1.1	1.0	0.8	1.0	0.8	0.8
60%	0.5	0.5	0.9	1.2	2.2	1.8	0.9	0.9	0.7	0.9	0.7	0.7
70%	0.4	0.5	0.7	1.0	1.7	1.5	0.8	0.8	0.6	0.8	0.7	0.6
80%	0.4	0.4	0.6	0.9	1.3	1.2	0.7	0.7	0.6	0.6	0.6	0.5
90%	0.3	0.2	0.5	0.7	1.1	0.7	0.6	0.6	0.4	0.5	0.5	0.5
Long Term												
Full Simulation Period ^b	0.6	0.9	1.9	3.0	3.9	3.1	2.0	1.6	1.0	1.0	0.8	0.8
Water Year Types^c												
Wet (32%)	0.7	1.3	3.8	5.4	6.2	5.2	3.5	2.9	1.6	1.1	0.9	0.9
Above Normal (16%)	0.5	1.0	2.0	4.0	5.1	4.4	2.2	1.5	0.9	1.2	0.9	0.8
Below Normal (13%)	0.6	0.8	1.0	1.5	3.1	1.6	1.1	1.1	0.9	1.1	0.8	0.8
Dry (24%)	0.5	0.5	0.8	1.2	2.1	1.9	1.1	0.9	0.7	0.7	0.6	0.6
Critical (15%)	0.4	0.4	0.6	1.0	1.3	1.0	0.7	0.5	0.5	0.5	0.5	0.5

No Action Alternative

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1.1	2.0	5.2	7.0	7.9	6.9	5.0	3.8	1.3	1.4	1.0	2.8
20%	0.9	1.5	3.0	5.6	6.8	5.5	3.3	2.3	0.9	1.3	0.9	2.7
30%	0.8	1.4	1.9	3.8	5.3	3.7	2.0	1.3	0.7	1.3	0.9	1.5
40%	0.7	1.2	1.4	2.4	4.4	2.8	1.6	1.0	0.7	1.2	0.9	1.2
50%	0.6	0.9	1.2	1.9	3.1	2.2	1.1	0.9	0.6	1.1	0.8	0.9
60%	0.5	0.7	1.0	1.4	2.1	1.8	0.9	0.8	0.6	1.0	0.8	0.7
70%	0.4	0.6	0.8	1.1	1.6	1.5	0.8	0.7	0.6	0.9	0.7	0.6
80%	0.4	0.4	0.7	1.0	1.3	1.2	0.7	0.6	0.5	0.8	0.6	0.6
90%	0.3	0.3	0.5	0.8	1.1	0.7	0.6	0.5	0.4	0.6	0.5	0.5
Long Term												
Full Simulation Period ^b	0.7	1.2	2.0	3.0	3.8	3.1	2.0	1.5	0.9	1.0	0.8	1.4
Water Year Types^c												
Wet (32%)	0.9	1.7	3.6	5.3	6.1	5.1	3.5	2.9	1.5	1.2	0.9	2.6
Above Normal (16%)	0.6	1.4	2.2	3.9	5.0	4.2	2.2	1.4	0.7	1.3	1.0	1.2
Below Normal (13%)	0.7	1.1	1.2	1.6	2.9	1.5	1.0	0.9	0.6	1.2	0.9	0.8
Dry (24%)	0.5	0.8	0.9	1.4	2.1	1.9	1.1	0.8	0.6	0.9	0.6	0.6
Critical (15%)	0.4	0.4	0.7	1.1	1.3	0.9	0.7	0.5	0.4	0.6	0.5	0.5

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.2	0.5	-0.6	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	1.8
20%	0.2	0.7	-0.3	-0.4	0.0	0.0	0.0	-0.3	-0.1	0.1	0.0	1.8
30%	0.2	0.6	0.3	-0.3	-0.2	-0.6	0.0	-0.1	-0.2	0.1	0.1	0.6
40%	0.1	0.5	0.3	-0.1	-0.3	-0.1	0.0	-0.1	-0.2	0.1	0.1	0.4
50%	0.1	0.4	0.3	0.2	-0.1	0.0	0.0	-0.1	-0.2	0.1	0.1	0.1
60%	0.0	0.2	0.1	0.2	0.0	0.0	0.0	-0.1	-0.1	0.1	0.1	0.0
70%	0.0	0.1	0.1	0.2	-0.1	0.0	0.0	-0.1	-0.1	0.1	0.0	0.0
80%	0.0	0.1	0.1	0.2	0.0	0.0	0.0	-0.1	-0.1	0.2	0.0	0.0
90%	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	-0.1	0.1	0.0	0.0
Long Term												
Full Simulation Period ^b	0.1	0.3	0.0	0.0	-0.1	-0.1	0.0	-0.1	-0.1	0.1	0.0	0.6
Water Year Types^c												
Wet (32%)	0.2	0.3	-0.2	-0.1	-0.1	-0.1	0.0	0.0	0.0	0.1	0.0	1.7
Above Normal (16%)	0.1	0.4	0.2	-0.1	-0.1	-0.2	0.0	-0.1	-0.2	0.1	0.0	0.4
Below Normal (13%)	0.1	0.3	0.1	0.1	-0.2	-0.1	0.0	-0.2	-0.3	0.1	0.1	0.0
Dry (24%)	0.0	0.3	0.1	0.2	0.0	0.0	0.0	-0.1	-0.1	0.1	0.0	0.0
Critical (15%)	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-44-2.5. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Minimum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.8	1.5	5.8	7.1	7.9	7.0	5.0	3.8	1.3	1.3	1.0	1.0
20%	0.7	0.9	3.3	6.1	6.8	5.5	3.2	2.5	1.0	1.2	0.9	0.9
30%	0.6	0.8	1.6	4.2	5.4	4.2	2.0	1.4	0.9	1.2	0.9	0.9
40%	0.6	0.7	1.2	2.5	4.7	2.9	1.6	1.1	0.9	1.1	0.8	0.8
50%	0.5	0.6	0.9	1.7	3.2	2.2	1.1	1.0	0.8	1.0	0.8	0.8
60%	0.5	0.5	0.9	1.2	2.2	1.8	0.9	0.9	0.7	0.9	0.7	0.7
70%	0.4	0.5	0.7	1.0	1.7	1.5	0.8	0.8	0.6	0.8	0.7	0.6
80%	0.4	0.4	0.6	0.9	1.3	1.2	0.7	0.7	0.6	0.6	0.6	0.5
90%	0.3	0.2	0.5	0.7	1.1	0.7	0.6	0.6	0.4	0.5	0.5	0.5
Long Term												
Full Simulation Period ^b	0.6	0.9	1.9	3.0	3.9	3.1	2.0	1.6	1.0	1.0	0.8	0.8
Water Year Types^c												
Wet (32%)	0.7	1.3	3.8	5.4	6.2	5.2	3.5	2.9	1.6	1.1	0.9	0.9
Above Normal (16%)	0.5	1.0	2.0	4.0	5.1	4.4	2.2	1.5	0.9	1.2	0.9	0.8
Below Normal (13%)	0.6	0.8	1.0	1.5	3.1	1.6	1.1	1.1	0.9	1.1	0.8	0.8
Dry (24%)	0.5	0.5	0.8	1.2	2.1	1.9	1.1	0.9	0.7	0.7	0.6	0.6
Critical (15%)	0.4	0.4	0.6	1.0	1.3	1.0	0.7	0.5	0.5	0.5	0.5	0.5

Alternative 3

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.8	1.5	5.7	7.1	7.9	7.0	5.0	3.8	1.2	1.4	1.0	1.0
20%	0.7	0.9	3.4	6.0	6.8	5.5	3.2	2.3	1.0	1.3	0.9	0.9
30%	0.6	0.8	1.6	4.2	5.5	3.9	2.0	1.5	0.9	1.3	0.9	0.9
40%	0.6	0.6	1.2	2.5	4.7	2.9	1.6	1.1	0.8	1.2	0.9	0.8
50%	0.5	0.6	0.9	1.7	3.2	2.2	1.1	1.0	0.8	1.1	0.8	0.8
60%	0.5	0.5	0.8	1.3	2.2	1.8	0.9	0.9	0.7	1.0	0.8	0.7
70%	0.4	0.4	0.7	1.0	1.7	1.5	0.8	0.8	0.7	0.8	0.7	0.6
80%	0.3	0.3	0.6	0.9	1.3	1.2	0.7	0.7	0.6	0.7	0.6	0.6
90%	0.3	0.2	0.4	0.7	1.1	0.7	0.6	0.5	0.4	0.6	0.5	0.5
Long Term												
Full Simulation Period ^b	0.6	0.9	1.9	3.0	3.9	3.1	2.0	1.6	1.0	1.0	0.8	0.8
Water Year Types^c												
Wet (32%)	0.7	1.3	3.8	5.4	6.2	5.1	3.5	2.9	1.6	1.2	0.9	0.9
Above Normal (16%)	0.5	1.0	2.0	3.9	5.1	4.3	2.2	1.5	0.8	1.3	0.9	0.8
Below Normal (13%)	0.6	0.7	1.1	1.5	3.1	1.6	1.1	1.0	0.8	1.3	0.9	0.8
Dry (24%)	0.5	0.5	0.8	1.3	2.1	1.9	1.1	0.9	0.7	0.8	0.6	0.6
Critical (15%)	0.4	0.4	0.6	0.9	1.3	0.9	0.7	0.5	0.5	0.5	0.5	0.5

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0
20%	0.0	0.0	0.1	0.0	0.0	0.0	0.0	-0.2	0.0	0.1	0.0	0.0
30%	0.0	0.0	0.0	0.0	0.0	-0.3	0.0	0.0	0.1	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0
Water Year Types^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0
Below Normal (13%)	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.2	0.1	0.1	0.1
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-44-2-6. Sacramento River d/s of Delta Cross Channel, Monthly Averaged Daily Minimum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.8	1.5	5.8	7.1	7.9	7.0	5.0	3.8	1.3	1.3	1.0	1.0
20%	0.7	0.9	3.3	6.1	6.8	5.5	3.2	2.5	1.0	1.2	0.9	0.9
30%	0.6	0.8	1.6	4.2	5.4	4.2	2.0	1.4	0.9	1.2	0.9	0.9
40%	0.6	0.7	1.2	2.5	4.7	2.9	1.6	1.1	0.9	1.1	0.8	0.8
50%	0.5	0.6	0.9	1.7	3.2	2.2	1.1	1.0	0.8	1.0	0.8	0.8
60%	0.5	0.5	0.9	1.2	2.2	1.8	0.9	0.9	0.7	0.9	0.7	0.7
70%	0.4	0.5	0.7	1.0	1.7	1.5	0.8	0.8	0.6	0.8	0.7	0.6
80%	0.4	0.4	0.6	0.9	1.3	1.2	0.7	0.7	0.6	0.6	0.6	0.5
90%	0.3	0.2	0.5	0.7	1.1	0.7	0.6	0.6	0.4	0.5	0.5	0.5
Long Term												
Full Simulation Period ^b	0.6	0.9	1.9	3.0	3.9	3.1	2.0	1.6	1.0	1.0	0.8	0.8
Water Year Types^c												
Wet (32%)	0.7	1.3	3.8	5.4	6.2	5.2	3.5	2.9	1.6	1.1	0.9	0.9
Above Normal (16%)	0.5	1.0	2.0	4.0	5.1	4.4	2.2	1.5	0.9	1.2	0.9	0.8
Below Normal (13%)	0.6	0.8	1.0	1.5	3.1	1.6	1.1	1.1	0.9	1.1	0.8	0.8
Dry (24%)	0.5	0.5	0.8	1.2	2.1	1.9	1.1	0.9	0.7	0.7	0.6	0.6
Critical (15%)	0.4	0.4	0.6	1.0	1.3	1.0	0.7	0.5	0.5	0.5	0.5	0.5

Alternative 5

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1.1	2.0	5.2	7.0	7.9	6.9	5.0	3.8	1.3	1.4	1.0	2.8
20%	0.9	1.5	3.0	5.6	6.8	5.5	3.3	2.3	0.9	1.3	1.0	2.7
30%	0.8	1.4	1.9	3.8	5.3	3.7	2.0	1.3	0.8	1.3	0.9	1.5
40%	0.7	1.2	1.4	2.3	4.4	2.8	1.6	1.0	0.7	1.2	0.9	1.2
50%	0.6	0.9	1.2	1.9	3.1	2.2	1.1	0.9	0.6	1.1	0.9	0.9
60%	0.5	0.7	1.0	1.4	2.1	1.8	0.9	0.8	0.6	1.0	0.8	0.8
70%	0.4	0.6	0.8	1.1	1.6	1.5	0.8	0.7	0.6	0.9	0.7	0.6
80%	0.4	0.4	0.7	1.0	1.3	1.2	0.7	0.6	0.5	0.8	0.6	0.6
90%	0.3	0.3	0.5	0.8	1.1	0.7	0.5	0.5	0.4	0.6	0.5	0.5
Long Term												
Full Simulation Period ^b	0.7	1.2	2.0	3.0	3.8	3.1	2.0	1.5	0.9	1.1	0.8	1.3
Water Year Types^c												
Wet (32%)	0.9	1.7	3.6	5.3	6.1	5.1	3.5	2.9	1.5	1.2	0.9	2.6
Above Normal (16%)	0.6	1.4	2.2	3.9	5.0	4.2	2.2	1.4	0.7	1.3	1.0	1.2
Below Normal (13%)	0.7	1.1	1.2	1.6	2.9	1.5	1.0	0.9	0.6	1.2	0.9	0.8
Dry (24%)	0.5	0.8	0.9	1.4	2.1	1.9	1.1	0.8	0.6	0.9	0.6	0.6
Critical (15%)	0.4	0.4	0.7	1.1	1.3	0.9	0.6	0.5	0.4	0.6	0.5	0.5

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.2	0.5	-0.6	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	1.8
20%	0.2	0.7	-0.3	-0.4	-0.1	0.0	0.0	-0.3	-0.2	0.1	0.0	1.8
30%	0.2	0.7	0.3	-0.3	-0.1	-0.6	0.0	-0.1	-0.2	0.1	0.1	0.6
40%	0.1	0.5	0.3	-0.1	-0.3	-0.1	0.0	-0.1	-0.2	0.1	0.1	0.4
50%	0.1	0.4	0.3	0.2	0.0	0.0	0.0	-0.2	-0.1	0.1	0.1	0.1
60%	0.0	0.2	0.1	0.2	0.0	0.0	0.0	-0.2	-0.1	0.1	0.1	0.0
70%	0.0	0.1	0.1	0.2	-0.1	0.0	0.0	-0.1	-0.1	0.1	0.0	0.0
80%	0.0	0.1	0.1	0.2	0.0	0.0	-0.1	-0.1	-0.1	0.2	0.0	0.0
90%	0.0	0.0	0.0	0.1	0.0	0.0	0.0	-0.1	-0.1	0.1	0.0	0.0
Long Term												
Full Simulation Period ^b	0.1	0.3	0.0	0.0	-0.1	-0.1	0.0	-0.1	-0.1	0.1	0.0	0.6
Water Year Types^c												
Wet (32%)	0.2	0.4	-0.2	-0.1	0.0	-0.1	0.0	0.0	0.0	0.1	0.1	1.6
Above Normal (16%)	0.1	0.4	0.2	-0.1	-0.1	-0.2	0.0	-0.1	-0.2	0.1	0.0	0.4
Below Normal (13%)	0.1	0.3	0.1	0.1	-0.2	-0.1	0.0	-0.2	-0.3	0.1	0.1	0.0
Dry (24%)	0.0	0.3	0.1	0.2	0.0	0.0	0.0	-0.1	-0.1	0.2	0.0	0.0
Critical (15%)	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 **C.45. Sacramento River at Rio Vista Water Surface Elevation**

Figure C-45-1-1. Sacramento River at Rio Vista, Monthly Averaged Daily Maximum Elevation, October

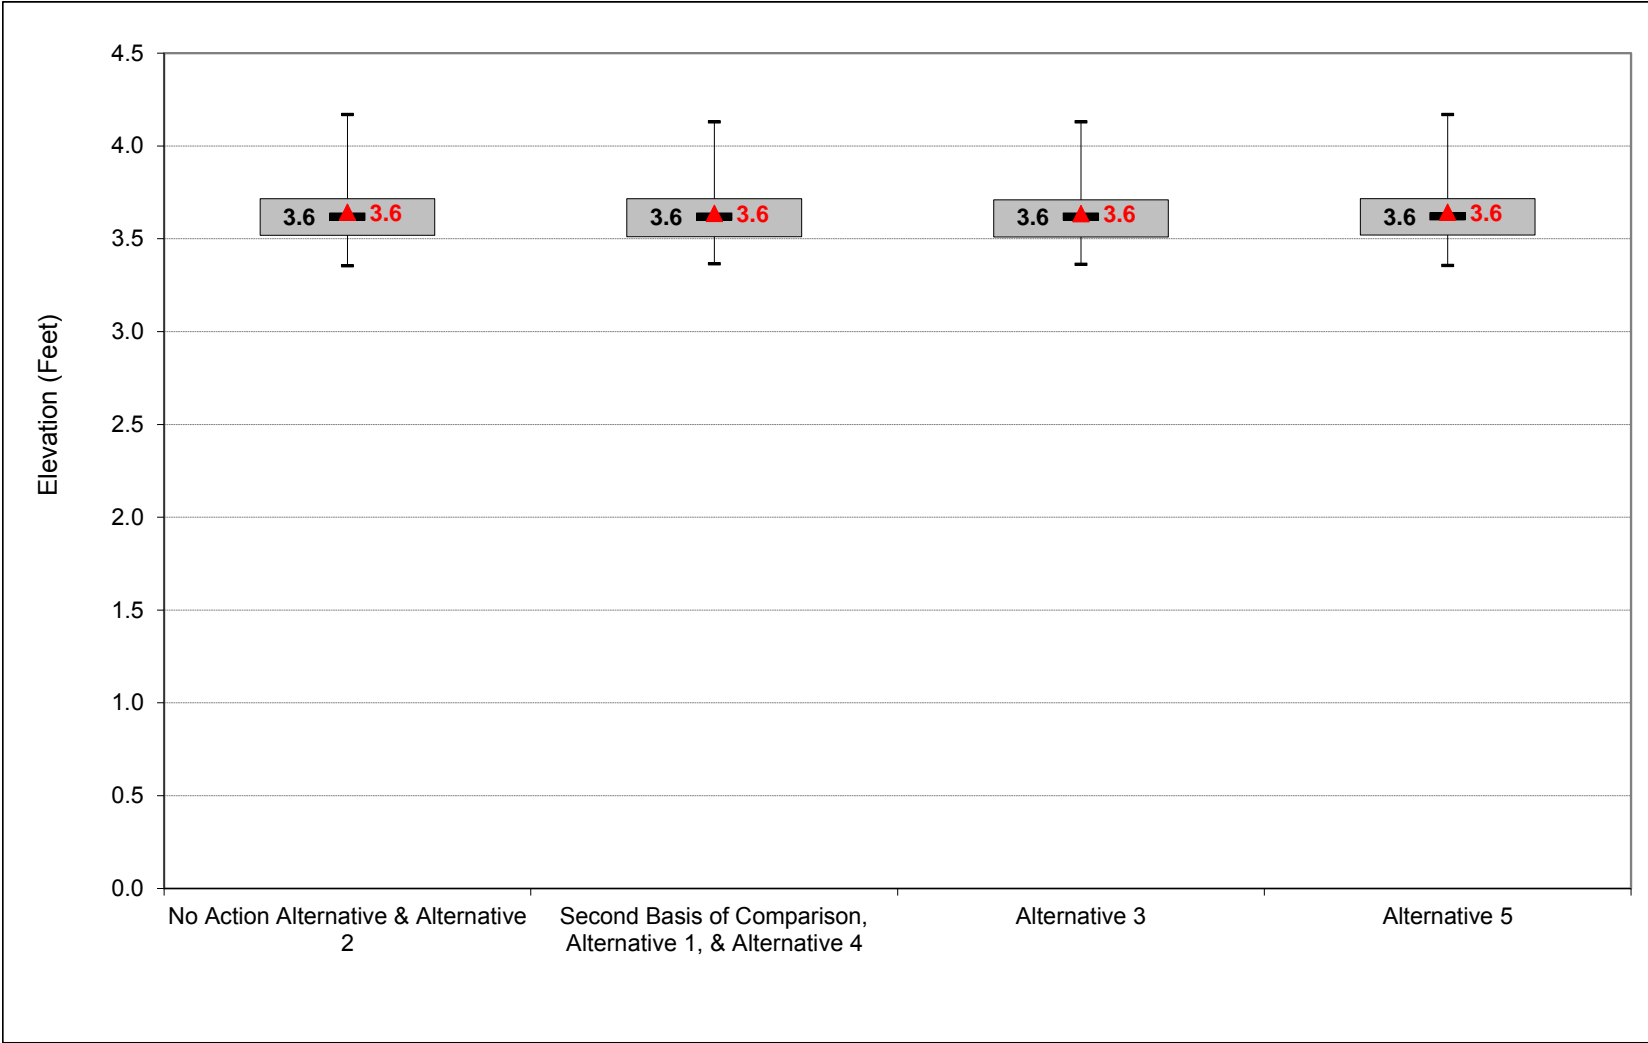


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-45-1-2. Sacramento River at Rio Vista, Monthly Averaged Daily Maximum Elevation, November

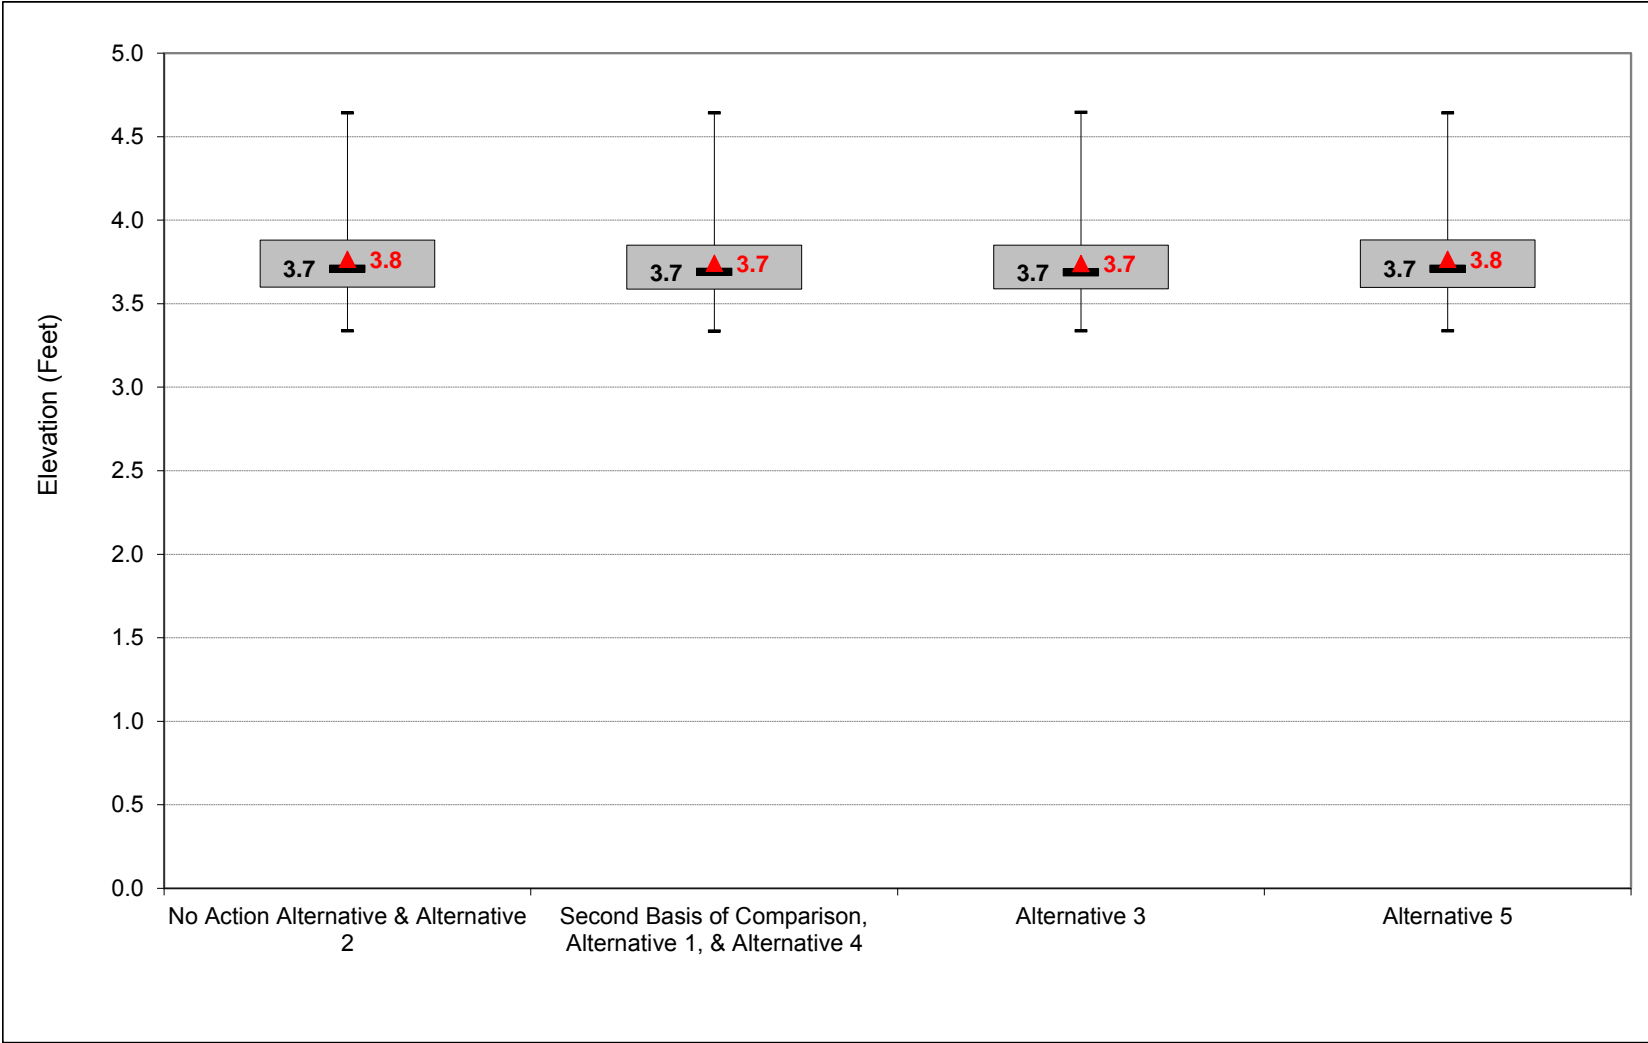


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-45-1-3. Sacramento River at Rio Vista, Monthly Averaged Daily Maximum Elevation, December

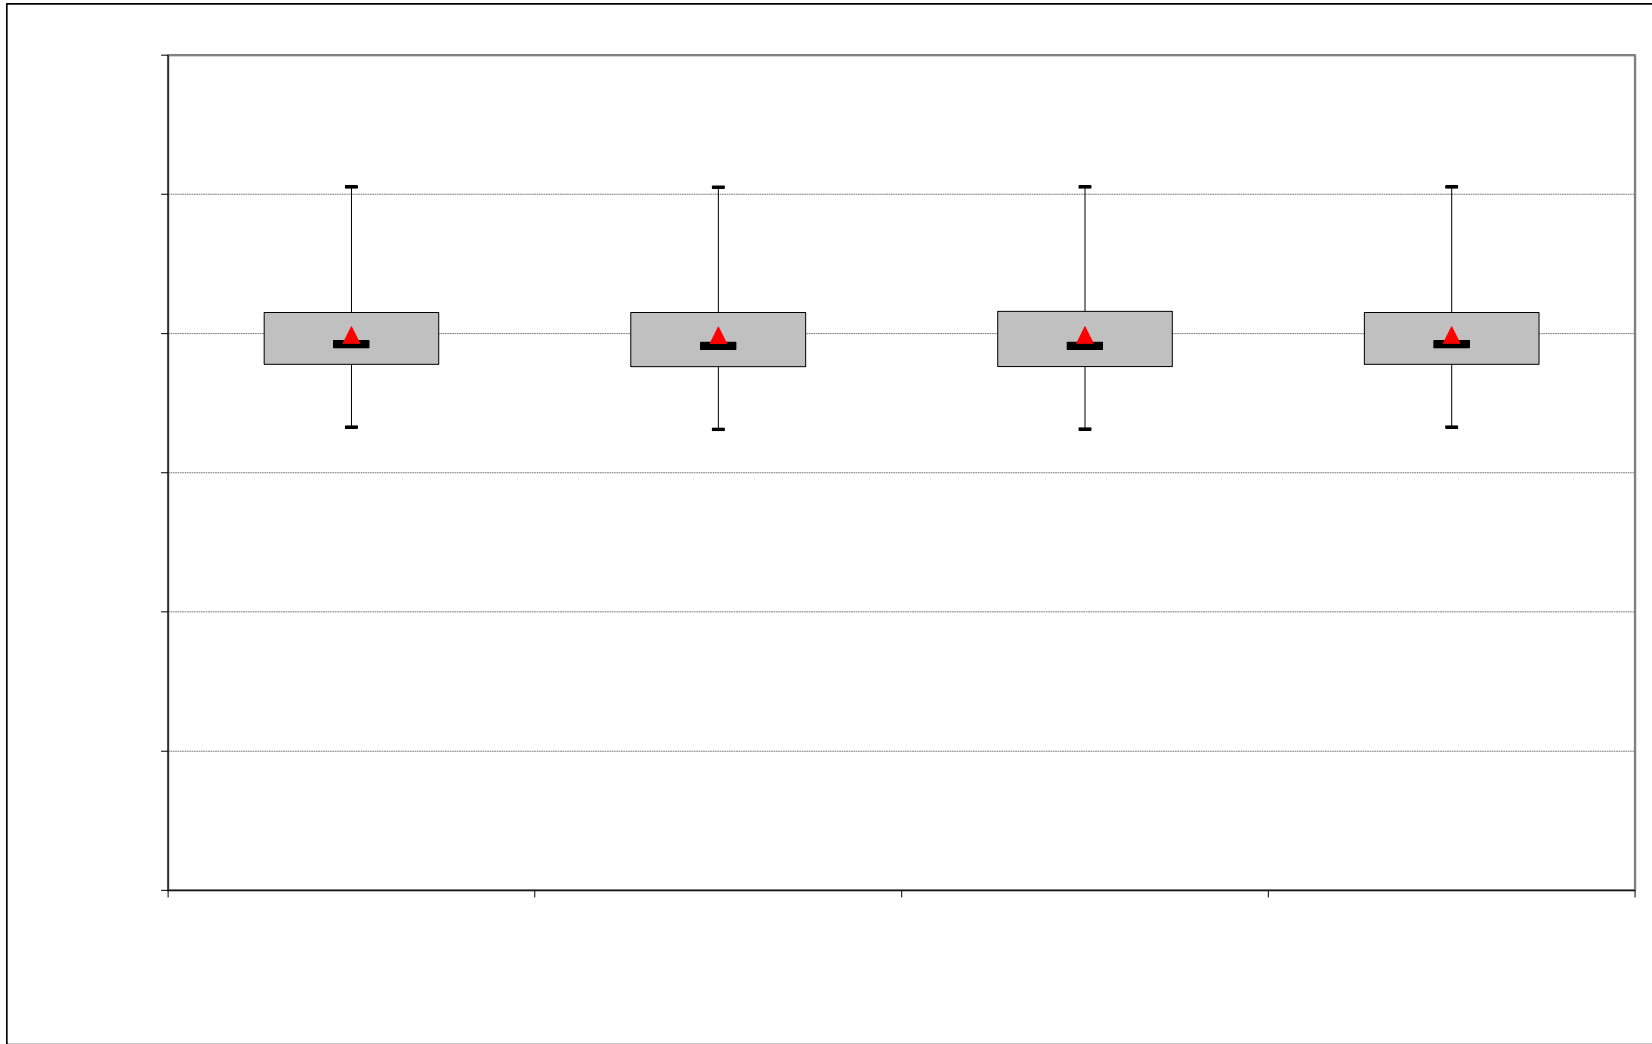


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-45-1-4. Sacramento River at Rio Vista, Monthly Averaged Daily Maximum Elevation, January

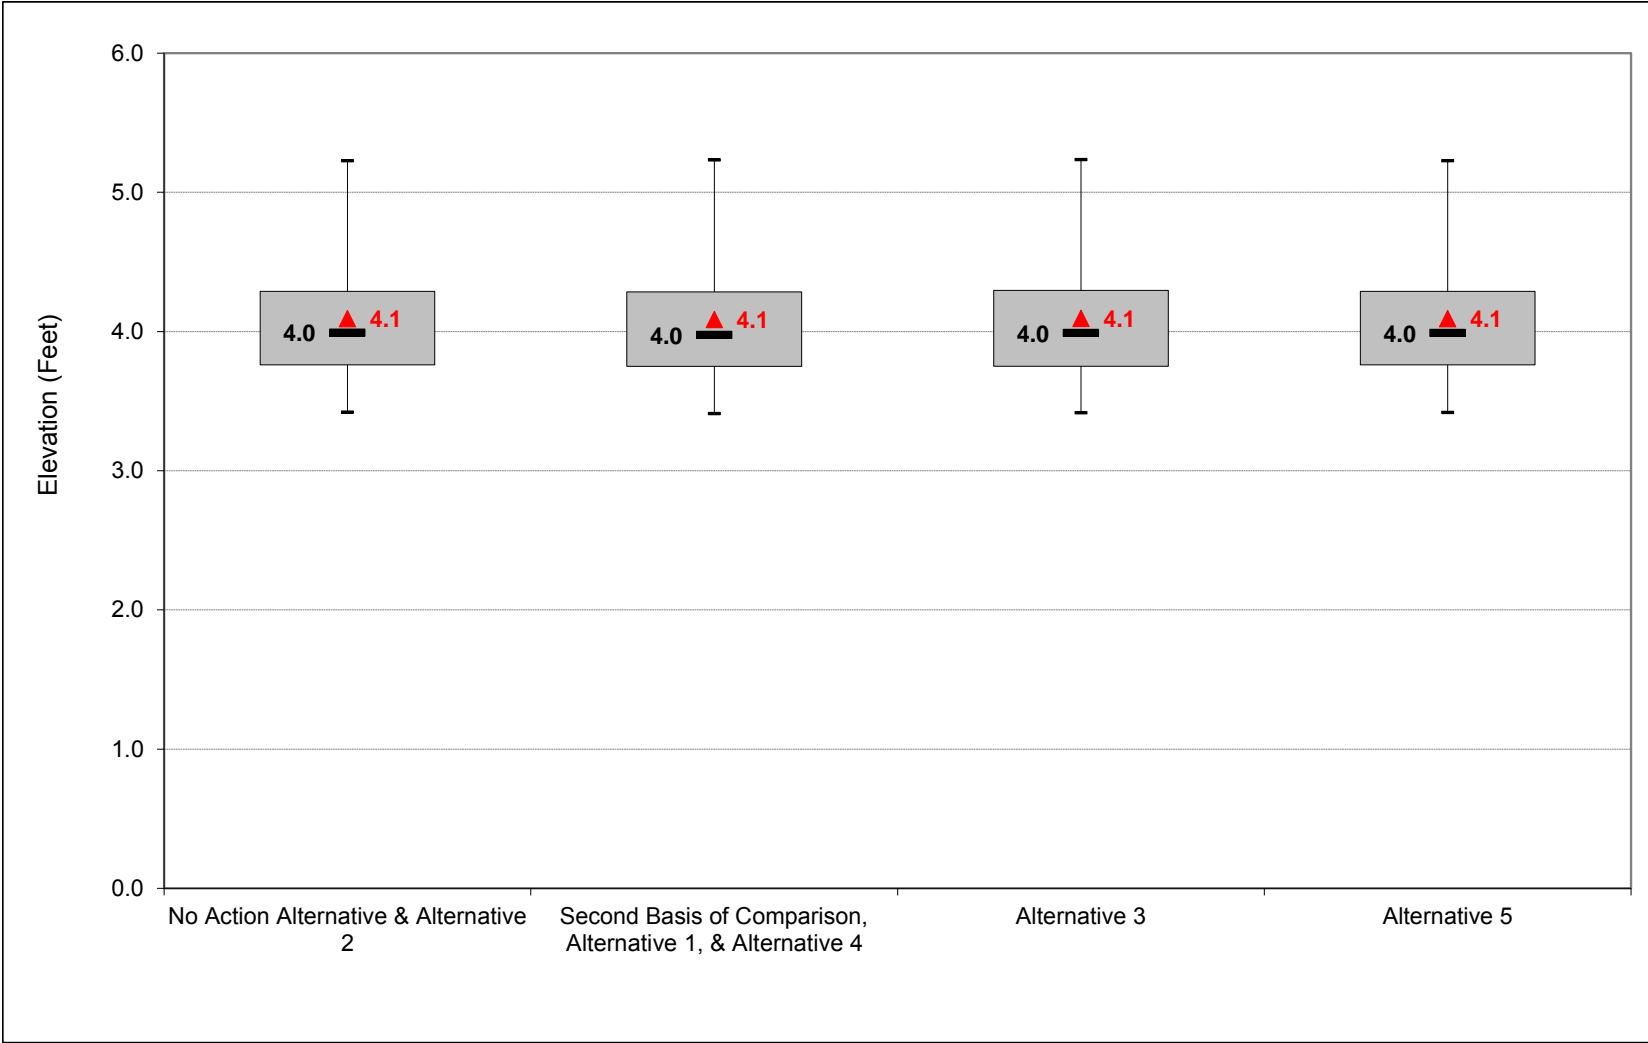


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-45-1-5. Sacramento River at Rio Vista, Monthly Averaged Daily Maximum Elevation, February

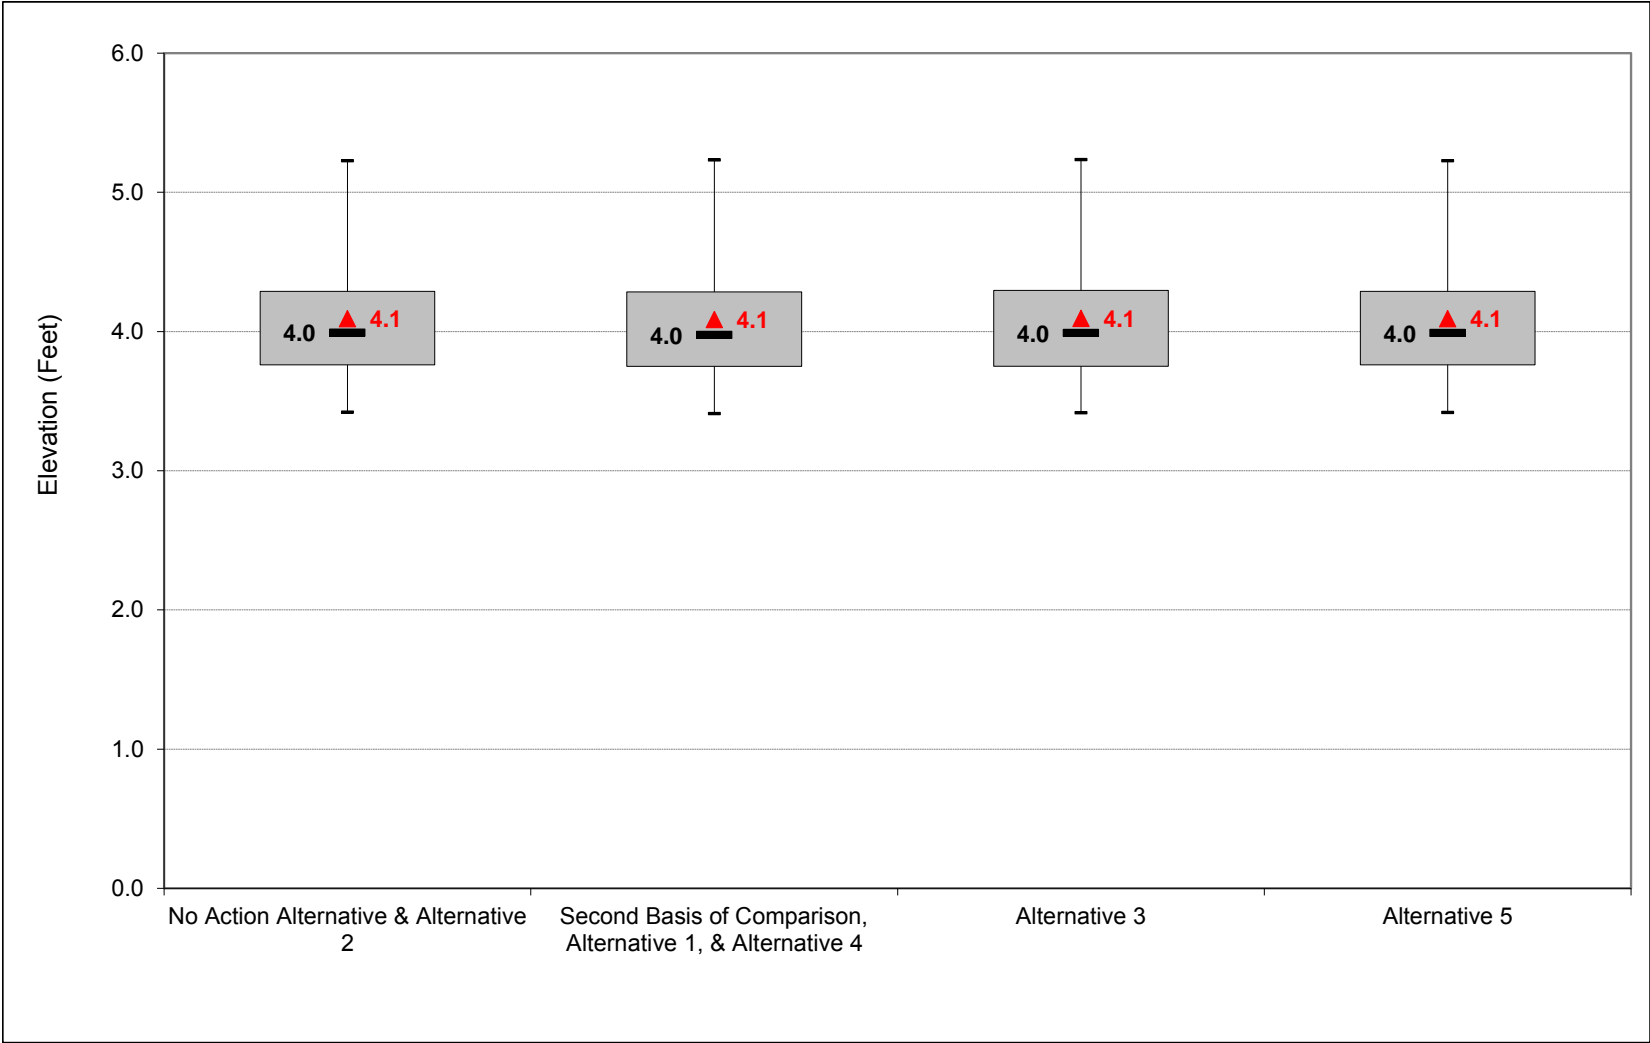


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-45-1-6. Sacramento River at Rio Vista, Monthly Averaged Daily Maximum Elevation, March

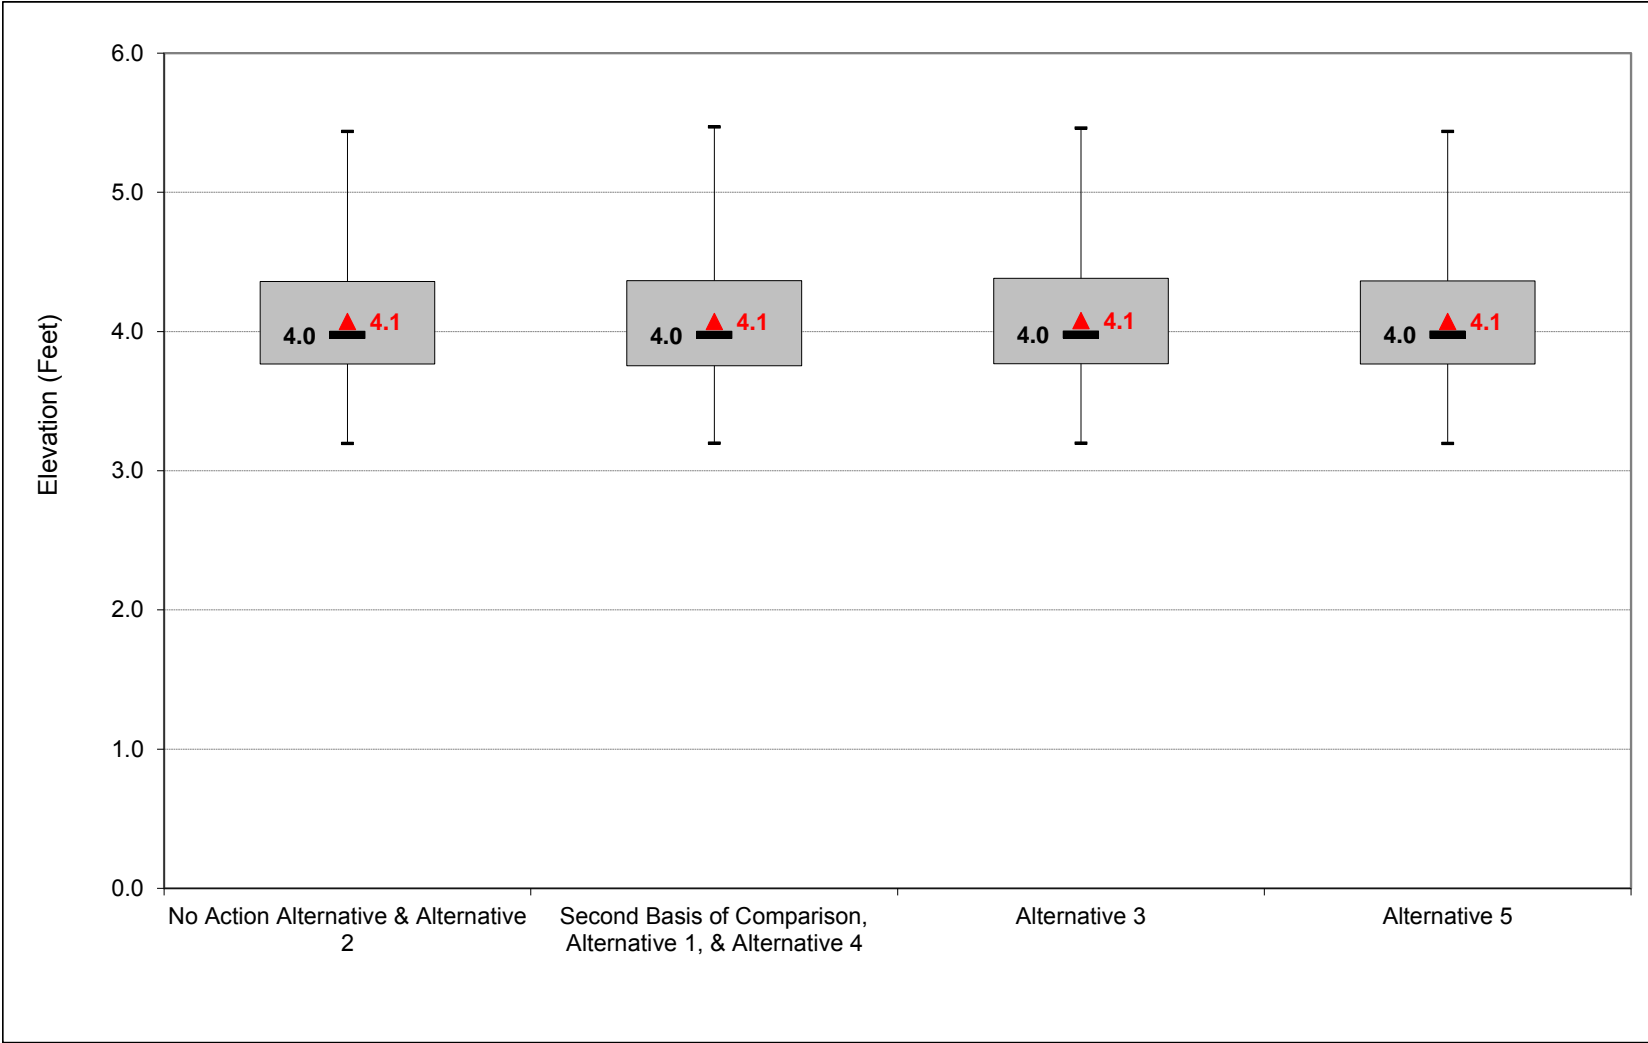


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-45-1-7. Sacramento River at Rio Vista, Monthly Averaged Daily Maximum Elevation, April

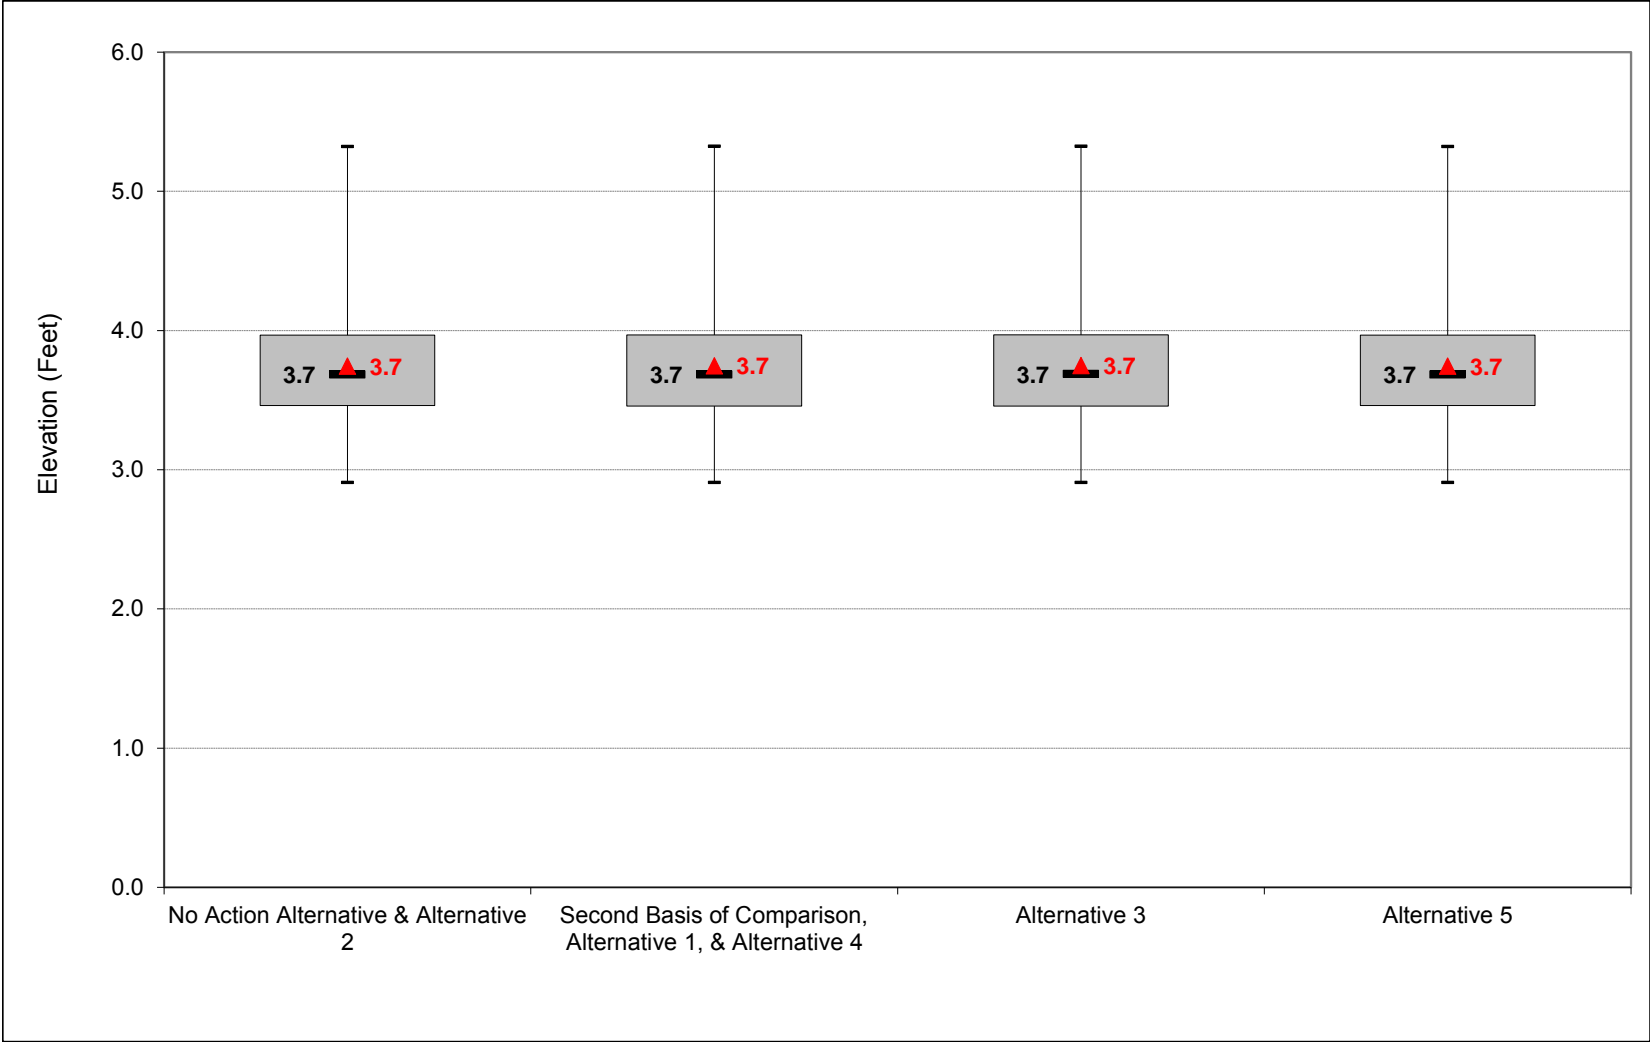


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-45-1-8. Sacramento River at Rio Vista, Monthly Averaged Daily Maximum Elevation, May

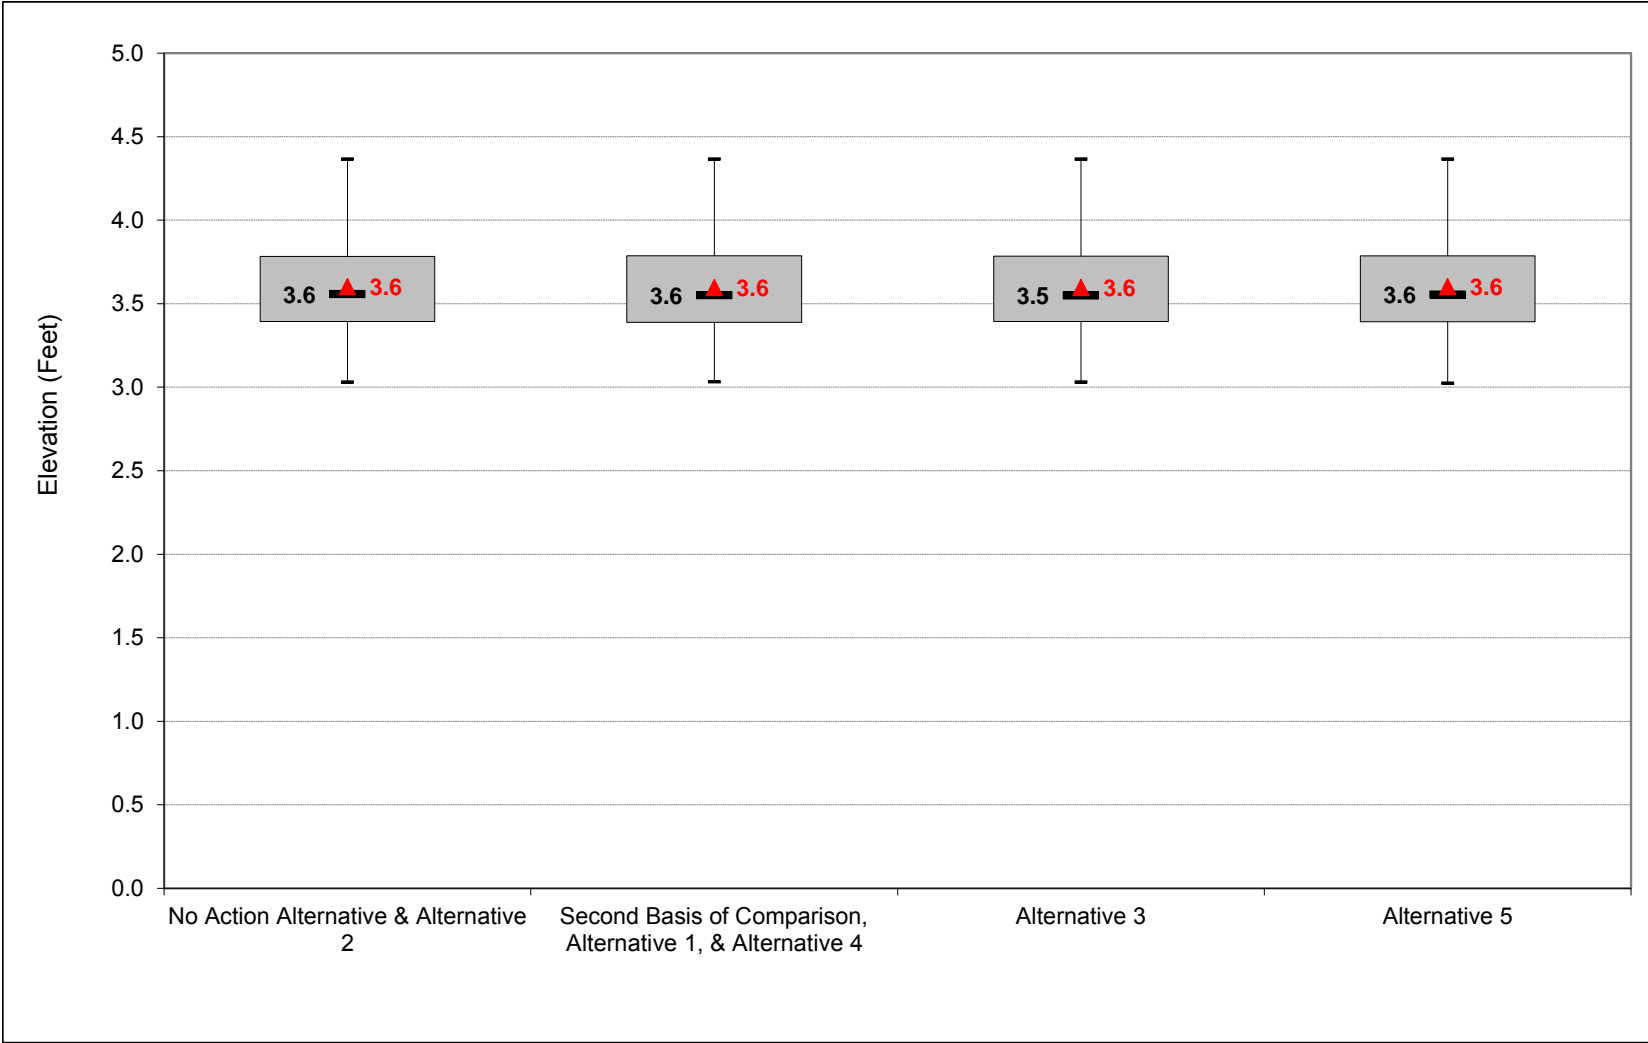


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-45-1-9. Sacramento River at Rio Vista, Monthly Averaged Daily Maximum Elevation, June

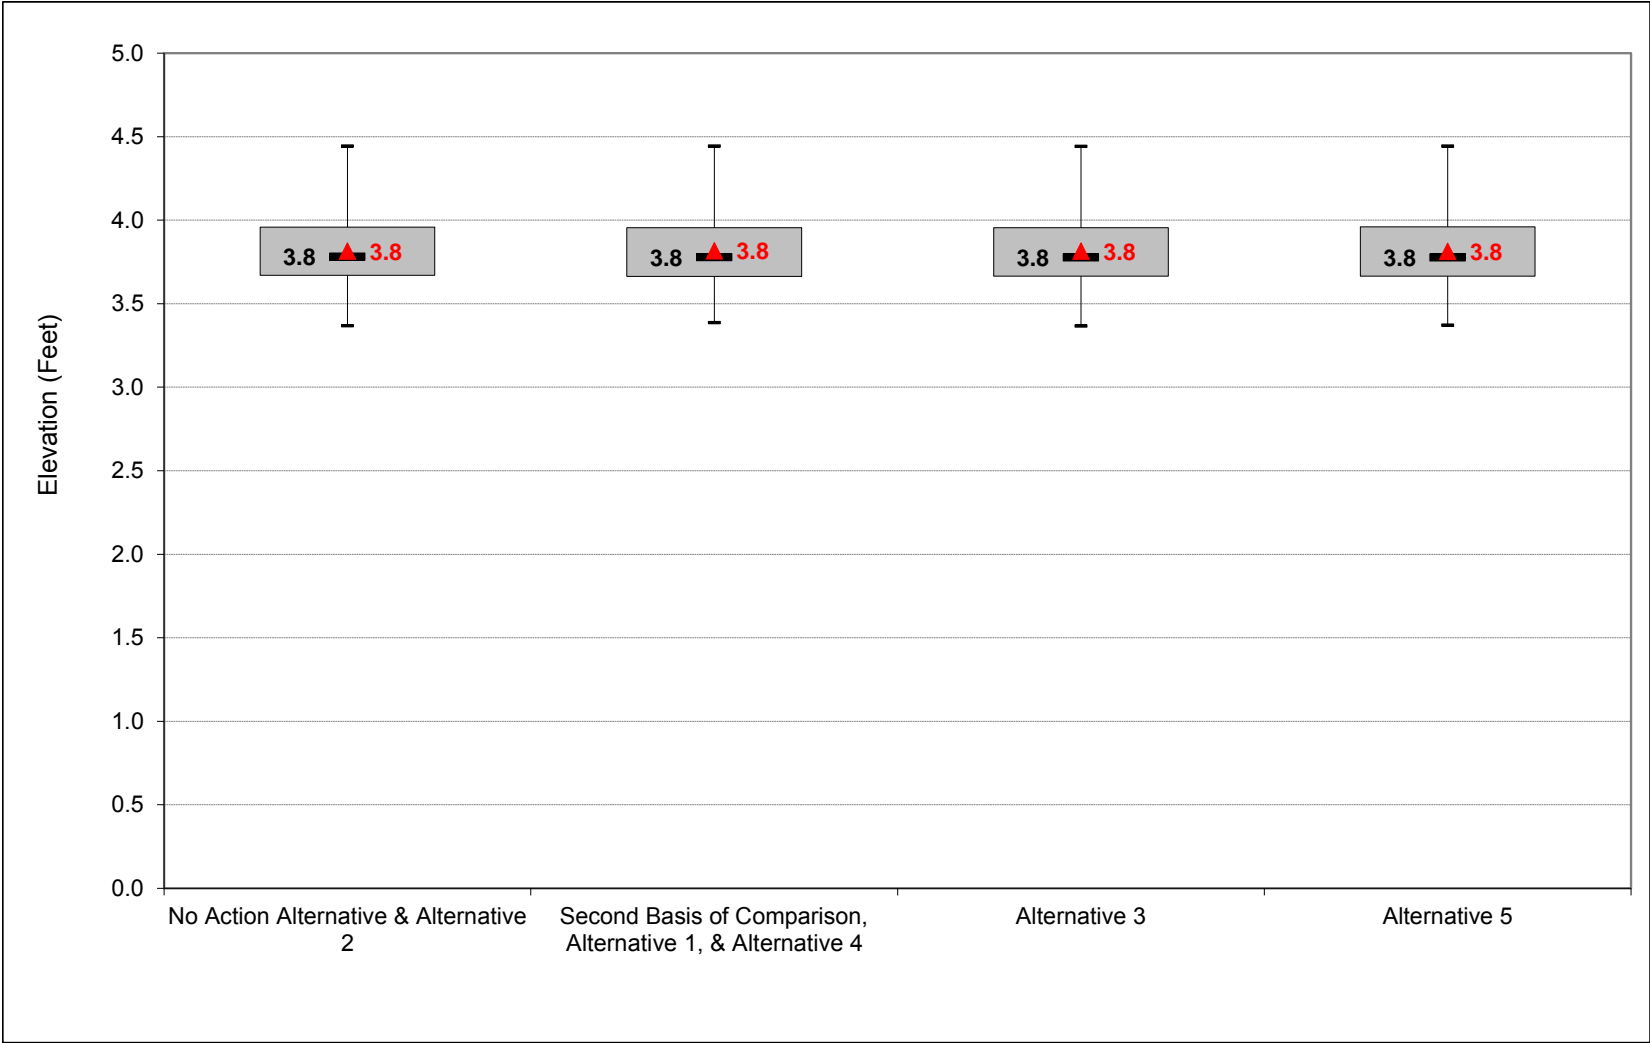


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-45-1-10. Sacramento River at Rio Vista, Monthly Averaged Daily Maximum Elevation, July

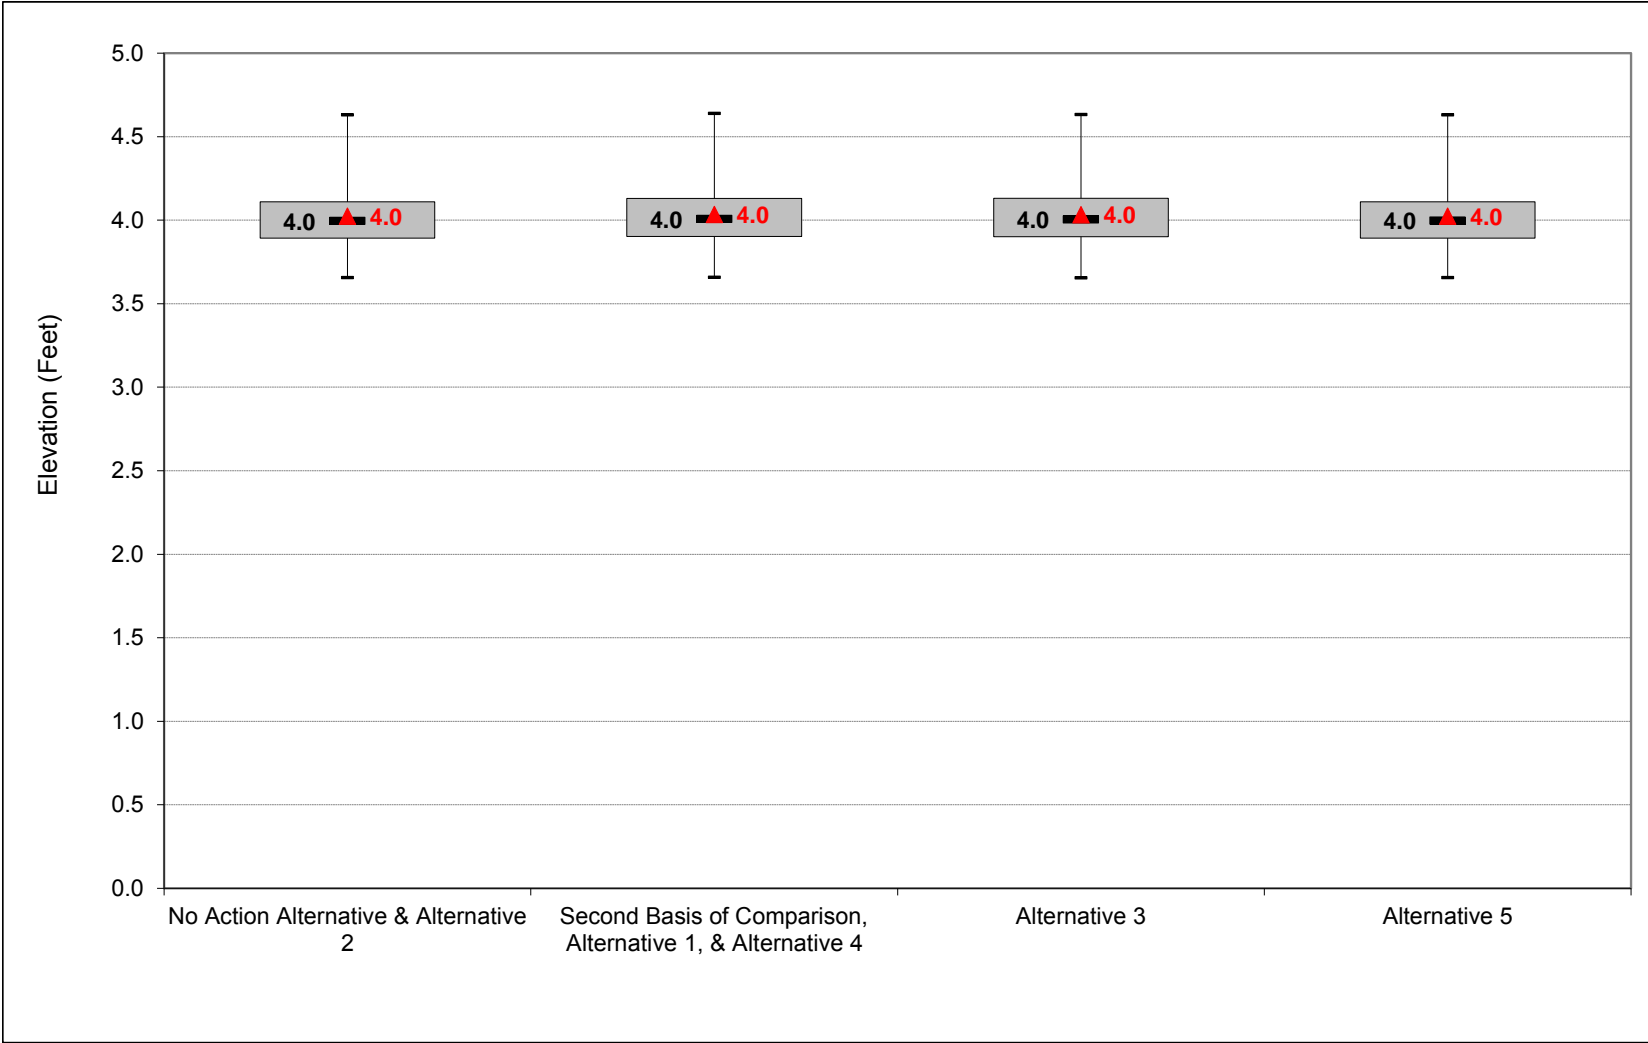


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-45-1-11. Sacramento River at Rio Vista, Monthly Averaged Daily Maximum Elevation, August

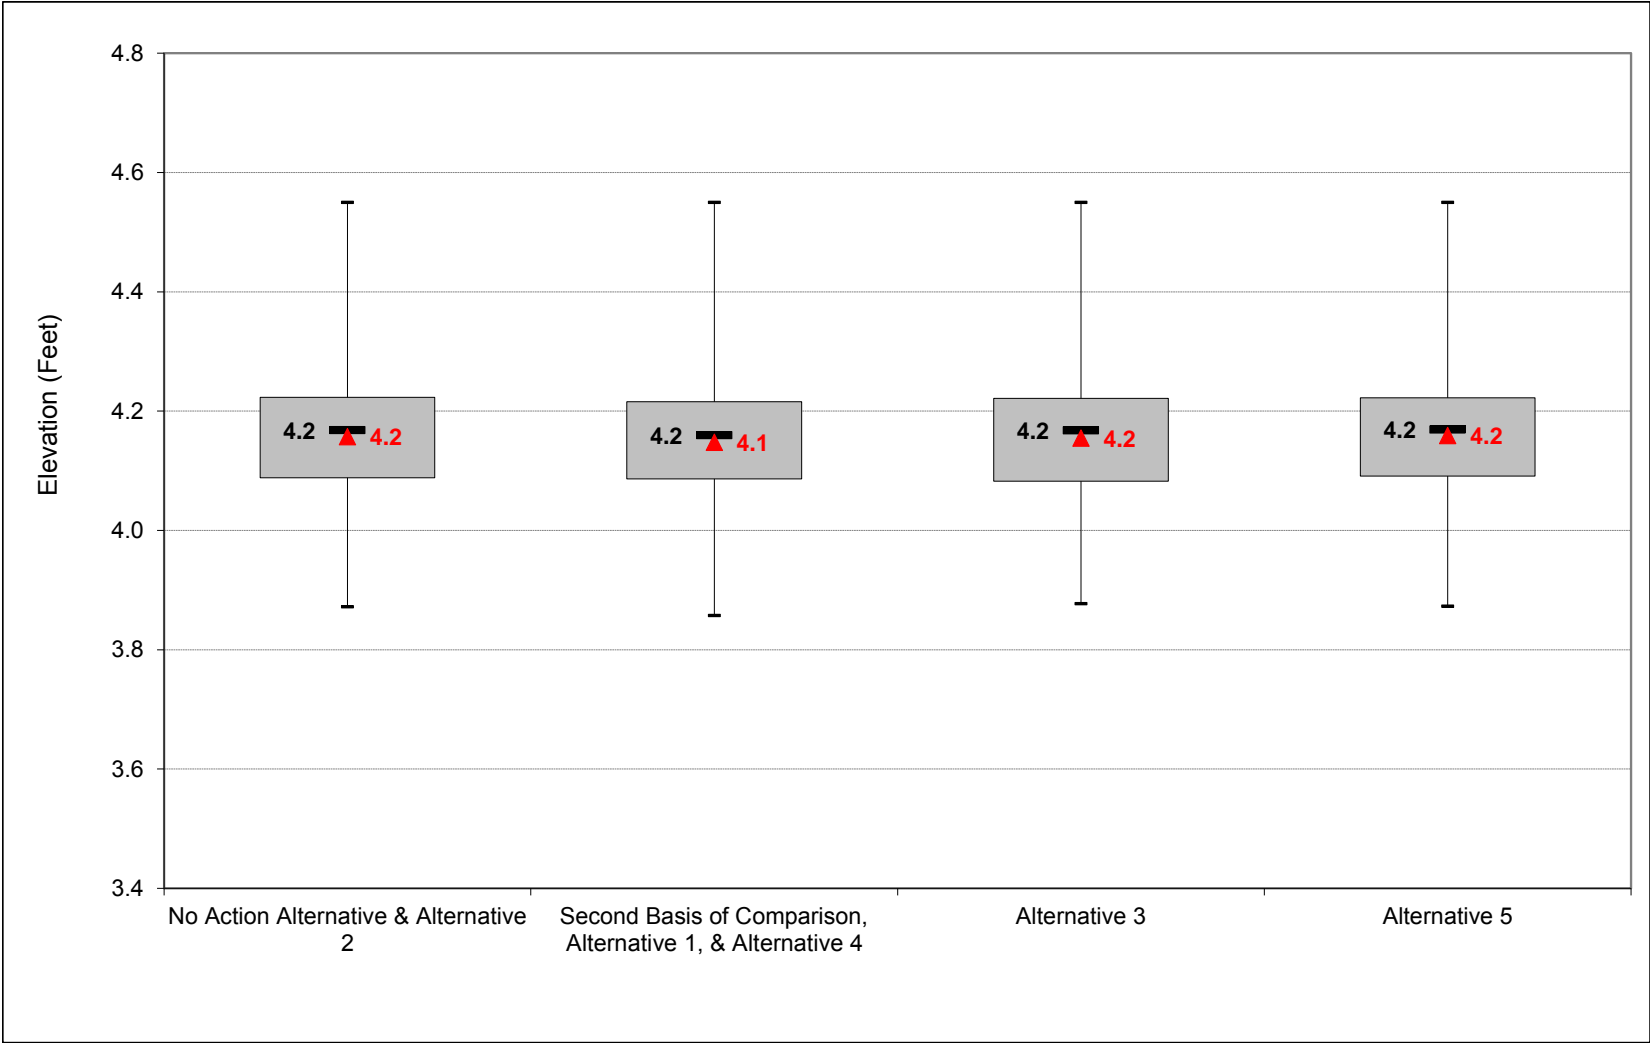

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-45-1-12. Sacramento River at Rio Vista, Monthly Averaged Daily Maximum Elevation, September

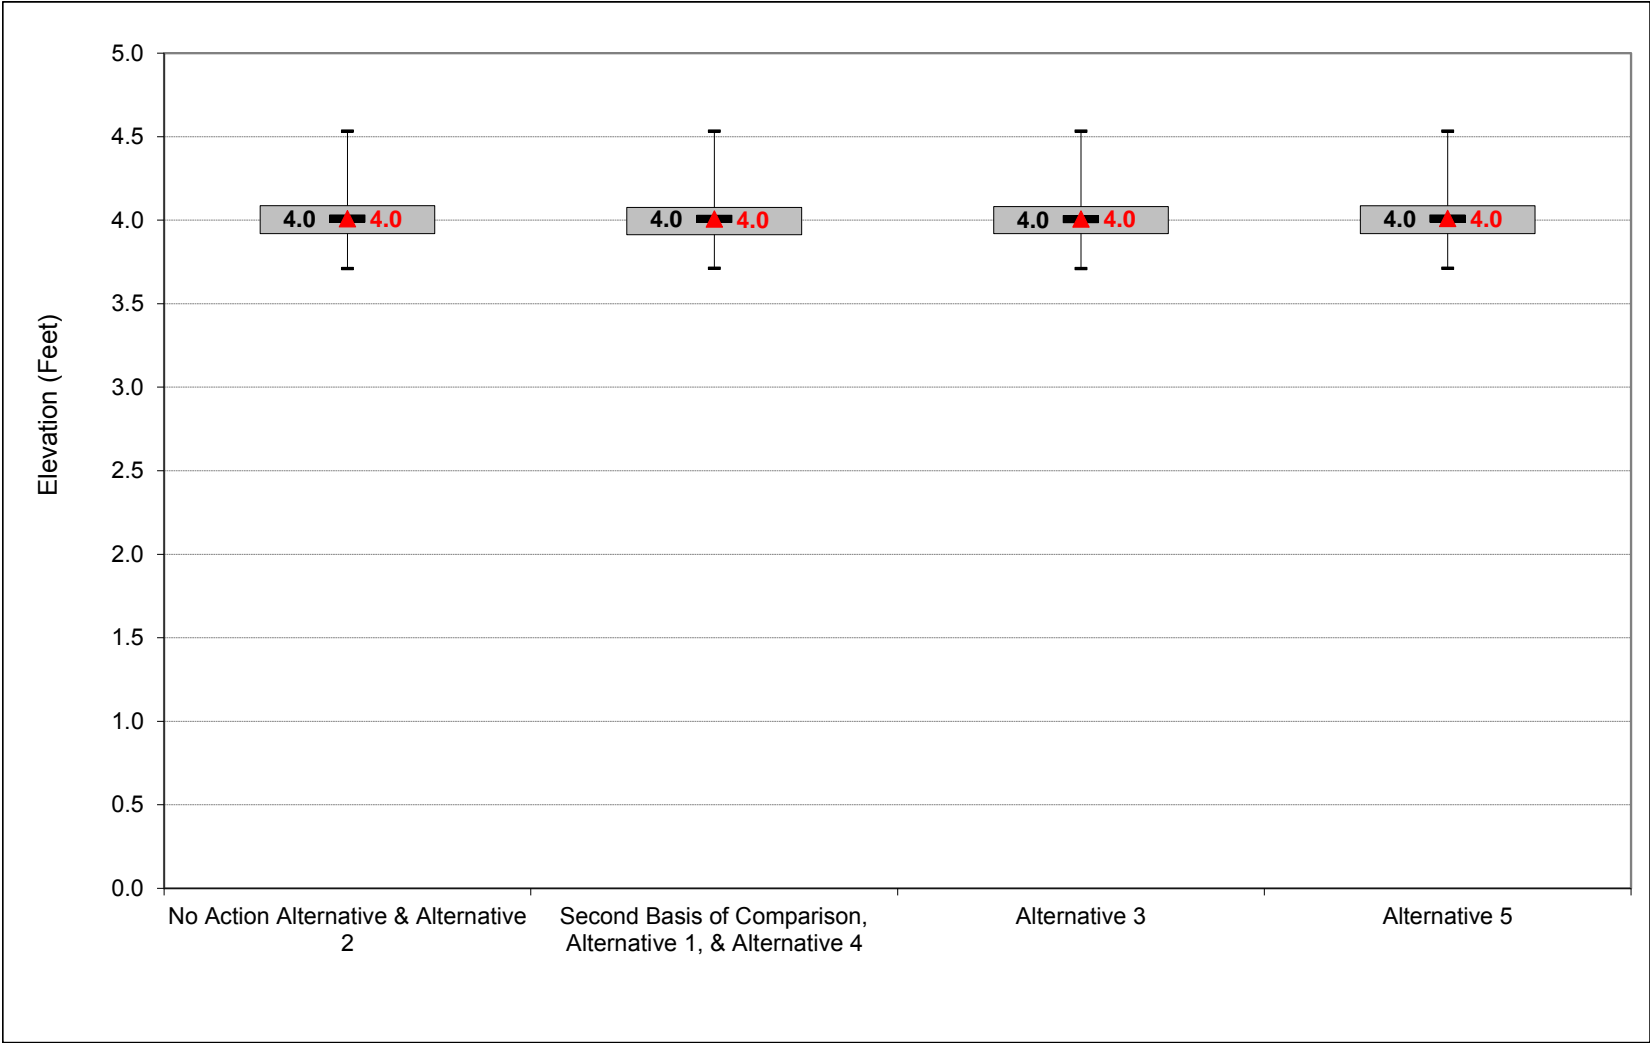

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-45-1-1. Sacramento River at Rio Vista, Monthly Averaged Daily Maximum Elevation

No Action Alternative												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3.9	4.0	4.5	4.7	4.7	4.3	4.0	4.1	4.2	4.3	4.1	4.1
20%	3.8	3.9	4.3	4.5	4.5	4.0	3.8	4.0	4.1	4.2	4.1	4.0
30%	3.7	3.8	4.1	4.2	4.3	3.9	3.7	3.9	4.1	4.2	4.1	4.0
40%	3.7	3.8	4.0	4.1	4.1	3.8	3.6	3.8	4.1	4.2	4.0	3.9
50%	3.6	3.7	3.9	4.0	4.0	3.7	3.6	3.8	4.0	4.2	4.0	3.9
60%	3.6	3.7	3.9	3.9	3.9	3.6	3.5	3.7	4.0	4.1	4.0	3.8
70%	3.5	3.6	3.8	3.8	3.8	3.5	3.4	3.7	3.9	4.1	3.9	3.8
80%	3.5	3.6	3.8	3.7	3.7	3.4	3.4	3.6	3.9	4.1	3.9	3.8
90%	3.5	3.5	3.6	3.7	3.5	3.3	3.3	3.6	3.8	4.0	3.9	3.7
Long Term												
Full Simulation Period ^b	3.6	3.8	4.0	4.1	4.1	3.7	3.6	3.8	4.0	4.2	4.0	3.9
Water Year Types^c												
Wet (32%)	3.7	3.9	4.3	4.4	4.4	4.0	3.8	4.0	4.1	4.2	4.0	4.1
Above Normal (16%)	3.6	3.8	4.0	4.2	4.3	3.8	3.6	3.8	4.0	4.2	4.0	3.8
Below Normal (13%)	3.6	3.7	3.9	3.9	3.9	3.5	3.5	3.7	4.0	4.2	4.0	3.9
Dry (24%)	3.6	3.6	3.8	3.8	3.8	3.6	3.5	3.7	4.0	4.1	4.0	3.8
Critical (15%)	3.7	3.7	3.9	3.8	3.8	3.5	3.5	3.7	4.0	4.1	4.0	3.8
Alternative 1												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3.9	4.0	4.5	4.7	4.7	4.3	4.0	4.1	4.2	4.2	4.1	4.0
20%	3.8	3.9	4.4	4.5	4.5	4.0	3.8	4.0	4.1	4.2	4.1	3.9
30%	3.7	3.8	4.0	4.2	4.3	3.9	3.7	3.9	4.1	4.2	4.1	3.9
40%	3.7	3.8	4.0	4.0	4.1	3.8	3.6	3.8	4.1	4.2	4.0	3.9
50%	3.6	3.7	3.9	4.0	4.0	3.7	3.6	3.8	4.0	4.2	4.0	3.8
60%	3.6	3.7	3.8	3.9	3.9	3.6	3.5	3.7	4.0	4.1	4.0	3.8
70%	3.5	3.6	3.8	3.8	3.8	3.5	3.4	3.7	3.9	4.1	3.9	3.8
80%	3.5	3.6	3.7	3.7	3.7	3.4	3.3	3.7	3.9	4.1	3.9	3.7
90%	3.5	3.5	3.6	3.7	3.5	3.3	3.3	3.6	3.9	4.0	3.9	3.7
Long Term												
Full Simulation Period ^b	3.6	3.7	4.0	4.1	4.1	3.7	3.6	3.8	4.0	4.1	4.0	3.8
Water Year Types^c												
Wet (32%)	3.7	3.8	4.3	4.4	4.4	4.1	3.8	3.9	4.1	4.2	4.0	3.9
Above Normal (16%)	3.6	3.8	4.0	4.2	4.3	3.8	3.6	3.9	4.0	4.2	4.0	3.8
Below Normal (13%)	3.6	3.7	3.9	3.9	3.9	3.5	3.5	3.7	4.0	4.1	4.0	3.9
Dry (24%)	3.6	3.6	3.8	3.8	3.8	3.6	3.5	3.7	4.0	4.1	4.0	3.8
Critical (15%)	3.7	3.7	3.9	3.8	3.8	3.5	3.5	3.7	4.0	4.1	4.0	3.8
Alternative 1 minus No Action Alternative												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
30%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
Water Year Types^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-45-1-2. Sacramento River at Rio Vista, Monthly Averaged Daily Maximum Elevation

No Action Alternative												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3.9	4.0	4.5	4.7	4.7	4.3	4.0	4.1	4.2	4.3	4.1	4.1
20%	3.8	3.9	4.3	4.5	4.5	4.0	3.8	4.0	4.1	4.2	4.1	4.0
30%	3.7	3.8	4.1	4.2	4.3	3.9	3.7	3.9	4.1	4.2	4.1	4.0
40%	3.7	3.8	4.0	4.1	4.1	3.8	3.6	3.8	4.1	4.2	4.0	3.9
50%	3.6	3.7	3.9	4.0	4.0	3.7	3.6	3.8	4.0	4.2	4.0	3.9
60%	3.6	3.7	3.9	3.9	3.9	3.6	3.5	3.7	4.0	4.1	4.0	3.8
70%	3.5	3.6	3.8	3.8	3.8	3.5	3.4	3.7	3.9	4.1	3.9	3.8
80%	3.5	3.6	3.8	3.7	3.7	3.4	3.4	3.6	3.9	4.1	3.9	3.8
90%	3.5	3.5	3.6	3.7	3.5	3.3	3.3	3.6	3.8	4.0	3.9	3.7
Long Term												
Full Simulation Period ^b	3.6	3.8	4.0	4.1	4.1	3.7	3.6	3.8	4.0	4.2	4.0	3.9
Water Year Types^c												
Wet (32%)	3.7	3.9	4.3	4.4	4.4	4.0	3.8	4.0	4.1	4.2	4.0	4.1
Above Normal (16%)	3.6	3.8	4.0	4.2	4.3	3.8	3.6	3.8	4.0	4.2	4.0	3.8
Below Normal (13%)	3.6	3.7	3.9	3.9	3.9	3.5	3.5	3.7	4.0	4.2	4.0	3.9
Dry (24%)	3.6	3.6	3.8	3.8	3.8	3.6	3.5	3.7	4.0	4.1	4.0	3.8
Critical (15%)	3.7	3.7	3.9	3.8	3.8	3.5	3.5	3.7	4.0	4.1	4.0	3.8

Alternative 3												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3.9	4.0	4.5	4.7	4.7	4.3	4.0	4.1	4.2	4.3	4.1	4.0
20%	3.8	3.9	4.4	4.5	4.5	4.0	3.8	4.0	4.1	4.2	4.1	3.9
30%	3.7	3.8	4.1	4.2	4.3	3.9	3.7	3.9	4.1	4.2	4.1	3.9
40%	3.7	3.8	4.0	4.0	4.1	3.8	3.6	3.8	4.1	4.2	4.0	3.9
50%	3.6	3.7	3.9	4.0	4.0	3.7	3.5	3.8	4.0	4.2	4.0	3.8
60%	3.6	3.7	3.8	3.9	3.9	3.6	3.5	3.7	4.0	4.1	4.0	3.8
70%	3.5	3.6	3.8	3.8	3.8	3.5	3.4	3.7	3.9	4.1	3.9	3.8
80%	3.5	3.6	3.7	3.7	3.7	3.4	3.3	3.7	3.9	4.1	3.9	3.7
90%	3.5	3.5	3.6	3.7	3.5	3.3	3.3	3.6	3.9	4.0	3.9	3.7
Long Term												
Full Simulation Period ^b	3.6	3.7	4.0	4.1	4.1	3.7	3.6	3.8	4.0	4.2	4.0	3.8
Water Year Types^c												
Wet (32%)	3.7	3.8	4.3	4.5	4.4	4.0	3.8	3.9	4.1	4.2	4.0	3.9
Above Normal (16%)	3.6	3.8	4.0	4.2	4.3	3.8	3.6	3.8	4.0	4.2	4.0	3.8
Below Normal (13%)	3.6	3.7	3.9	3.9	3.9	3.5	3.5	3.7	4.0	4.2	4.0	3.9
Dry (24%)	3.6	3.6	3.8	3.8	3.8	3.6	3.5	3.7	4.0	4.1	4.0	3.8
Critical (15%)	3.7	3.7	3.9	3.8	3.8	3.5	3.5	3.7	4.0	4.1	4.0	3.8

Alternative 3 minus No Action Alternative												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
30%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
Water Year Types^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.2
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-45-1-3. Sacramento River at Rio Vista, Monthly Averaged Daily Maximum Elevation

No Action Alternative												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3.9	4.0	4.5	4.7	4.7	4.3	4.0	4.1	4.2	4.3	4.1	4.1
20%	3.8	3.9	4.3	4.5	4.5	4.0	3.8	4.0	4.1	4.2	4.1	4.0
30%	3.7	3.8	4.1	4.2	4.3	3.9	3.7	3.9	4.1	4.2	4.1	4.0
40%	3.7	3.8	4.0	4.1	4.1	3.8	3.6	3.8	4.1	4.2	4.0	3.9
50%	3.6	3.7	3.9	4.0	4.0	3.7	3.6	3.8	4.0	4.2	4.0	3.9
60%	3.6	3.7	3.9	3.9	3.9	3.6	3.5	3.7	4.0	4.1	4.0	3.8
70%	3.5	3.6	3.8	3.8	3.8	3.5	3.4	3.7	3.9	4.1	3.9	3.8
80%	3.5	3.6	3.8	3.7	3.7	3.4	3.4	3.6	3.9	4.1	3.9	3.8
90%	3.5	3.5	3.6	3.7	3.5	3.3	3.3	3.6	3.8	4.0	3.9	3.7
Long Term												
Full Simulation Period ^b	3.6	3.8	4.0	4.1	4.1	3.7	3.6	3.8	4.0	4.2	4.0	3.9
Water Year Types^c												
Wet (32%)	3.7	3.9	4.3	4.4	4.4	4.0	3.8	4.0	4.1	4.2	4.0	4.1
Above Normal (16%)	3.6	3.8	4.0	4.2	4.3	3.8	3.6	3.8	4.0	4.2	4.0	3.8
Below Normal (13%)	3.6	3.7	3.9	3.9	3.9	3.5	3.5	3.7	4.0	4.2	4.0	3.9
Dry (24%)	3.6	3.6	3.8	3.8	3.8	3.6	3.5	3.7	4.0	4.1	4.0	3.8
Critical (15%)	3.7	3.7	3.9	3.8	3.8	3.5	3.5	3.7	4.0	4.1	4.0	3.8

Alternative 5												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3.9	4.0	4.5	4.7	4.7	4.3	4.0	4.1	4.2	4.3	4.2	4.1
20%	3.8	3.9	4.3	4.5	4.5	4.0	3.8	4.0	4.1	4.2	4.1	4.0
30%	3.7	3.8	4.1	4.2	4.3	3.9	3.7	3.9	4.1	4.2	4.1	4.0
40%	3.7	3.8	4.0	4.1	4.1	3.8	3.6	3.8	4.1	4.2	4.0	3.9
50%	3.6	3.7	3.9	4.0	4.0	3.7	3.6	3.8	4.0	4.2	4.0	3.9
60%	3.6	3.7	3.9	3.9	3.9	3.6	3.5	3.7	4.0	4.1	4.0	3.8
70%	3.5	3.6	3.8	3.8	3.8	3.5	3.4	3.7	3.9	4.1	3.9	3.8
80%	3.5	3.6	3.8	3.7	3.7	3.4	3.4	3.6	3.9	4.1	3.9	3.8
90%	3.5	3.5	3.6	3.7	3.5	3.3	3.3	3.6	3.8	4.0	3.9	3.7
Long Term												
Full Simulation Period ^b	3.6	3.8	4.0	4.1	4.1	3.7	3.6	3.8	4.0	4.2	4.0	3.9
Water Year Types^c												
Wet (32%)	3.7	3.9	4.3	4.4	4.4	4.0	3.8	4.0	4.1	4.2	4.0	4.1
Above Normal (16%)	3.6	3.8	4.0	4.2	4.3	3.8	3.6	3.8	4.0	4.2	4.0	3.8
Below Normal (13%)	3.6	3.7	3.9	3.9	3.9	3.5	3.5	3.7	4.0	4.2	4.0	3.9
Dry (24%)	3.6	3.6	3.8	3.8	3.8	3.6	3.5	3.7	4.0	4.1	4.0	3.8
Critical (15%)	3.7	3.7	3.9	3.8	3.8	3.5	3.5	3.7	4.0	4.1	4.0	3.8

Alternative 5 minus No Action Alternative												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
30%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-45-1-4. Sacramento River at Rio Vista, Monthly Averaged Daily Maximum Elevation

Second Basis of Comparison												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3.9	4.0	4.5	4.7	4.7	4.3	4.0	4.1	4.2	4.2	4.1	4.0
20%	3.8	3.9	4.4	4.5	4.5	4.0	3.8	4.0	4.1	4.2	4.1	3.9
30%	3.7	3.8	4.0	4.2	4.3	3.9	3.7	3.9	4.1	4.2	4.1	3.9
40%	3.7	3.8	4.0	4.0	4.1	3.8	3.6	3.8	4.1	4.2	4.0	3.9
50%	3.6	3.7	3.9	4.0	4.0	3.7	3.6	3.8	4.0	4.2	4.0	3.8
60%	3.6	3.7	3.8	3.9	3.9	3.6	3.5	3.7	4.0	4.1	4.0	3.8
70%	3.5	3.6	3.8	3.8	3.8	3.5	3.4	3.7	3.9	4.1	3.9	3.8
80%	3.5	3.6	3.7	3.7	3.7	3.4	3.3	3.7	3.9	4.1	3.9	3.7
90%	3.5	3.5	3.6	3.7	3.5	3.3	3.3	3.6	3.9	4.0	3.9	3.7
Long Term												
Full Simulation Period ^b	3.6	3.7	4.0	4.1	4.1	3.7	3.6	3.8	4.0	4.1	4.0	3.8
Water Year Types^c												
Wet (32%)	3.7	3.8	4.3	4.4	4.4	4.1	3.8	3.9	4.1	4.2	4.0	3.9
Above Normal (16%)	3.6	3.8	4.0	4.2	4.3	3.8	3.6	3.9	4.0	4.2	4.0	3.8
Below Normal (13%)	3.6	3.7	3.9	3.9	3.9	3.5	3.5	3.7	4.0	4.1	4.0	3.9
Dry (24%)	3.6	3.6	3.8	3.8	3.8	3.6	3.5	3.7	4.0	4.1	4.0	3.8
Critical (15%)	3.7	3.7	3.9	3.8	3.8	3.5	3.5	3.7	4.0	4.1	4.0	3.8

No Action Alternative												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3.9	4.0	4.5	4.7	4.7	4.3	4.0	4.1	4.2	4.3	4.1	4.1
20%	3.8	3.9	4.3	4.5	4.5	4.0	3.8	4.0	4.1	4.2	4.1	4.0
30%	3.7	3.8	4.1	4.2	4.3	3.9	3.7	3.9	4.1	4.2	4.1	4.0
40%	3.7	3.8	4.0	4.1	4.1	3.8	3.6	3.8	4.1	4.2	4.0	3.9
50%	3.6	3.7	3.9	4.0	4.0	3.7	3.6	3.8	4.0	4.2	4.0	3.9
60%	3.6	3.7	3.9	3.9	3.9	3.6	3.5	3.7	4.0	4.1	4.0	3.8
70%	3.5	3.6	3.8	3.8	3.8	3.5	3.4	3.7	3.9	4.1	3.9	3.8
80%	3.5	3.6	3.8	3.7	3.7	3.4	3.4	3.6	3.9	4.1	3.9	3.8
90%	3.5	3.5	3.6	3.7	3.5	3.3	3.3	3.6	3.8	4.0	3.9	3.7
Long Term												
Full Simulation Period ^b	3.6	3.8	4.0	4.1	4.1	3.7	3.6	3.8	4.0	4.2	4.0	3.9
Water Year Types^c												
Wet (32%)	3.7	3.9	4.3	4.4	4.4	4.0	3.8	4.0	4.1	4.2	4.0	4.1
Above Normal (16%)	3.6	3.8	4.0	4.2	4.3	3.8	3.6	3.8	4.0	4.2	4.0	3.8
Below Normal (13%)	3.6	3.7	3.9	3.9	3.9	3.5	3.5	3.7	4.0	4.2	4.0	3.9
Dry (24%)	3.6	3.6	3.8	3.8	3.8	3.6	3.5	3.7	4.0	4.1	4.0	3.8
Critical (15%)	3.7	3.7	3.9	3.8	3.8	3.5	3.5	3.7	4.0	4.1	4.0	3.8

No Action Alternative minus Second Basis of Comparison												
Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
30%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
Water Year Types^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-45-1-5. Sacramento River at Rio Vista, Monthly Averaged Daily Maximum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.9	4.0	4.5	4.7	4.7	4.3	4.0	4.1	4.2	4.2	4.1	4.0
20%	3.8	3.9	4.4	4.5	4.5	4.0	3.8	4.0	4.1	4.2	4.1	3.9
30%	3.7	3.8	4.0	4.2	4.3	3.9	3.7	3.9	4.1	4.2	4.1	3.9
40%	3.7	3.8	4.0	4.0	4.1	3.8	3.6	3.8	4.1	4.2	4.0	3.9
50%	3.6	3.7	3.9	4.0	4.0	3.7	3.6	3.8	4.0	4.2	4.0	3.8
60%	3.6	3.7	3.8	3.9	3.9	3.6	3.5	3.7	4.0	4.1	4.0	3.8
70%	3.5	3.6	3.8	3.8	3.8	3.5	3.4	3.7	3.9	4.1	3.9	3.8
80%	3.5	3.6	3.7	3.7	3.7	3.4	3.3	3.7	3.9	4.1	3.9	3.7
90%	3.5	3.5	3.6	3.7	3.5	3.3	3.3	3.6	3.9	4.0	3.9	3.7
Long Term												
Full Simulation Period ^b	3.6	3.7	4.0	4.1	4.1	3.7	3.6	3.8	4.0	4.1	4.0	3.8
Water Year Types ^c												
Wet (32%)	3.7	3.8	4.3	4.4	4.4	4.1	3.8	3.9	4.1	4.2	4.0	3.9
Above Normal (16%)	3.6	3.8	4.0	4.2	4.3	3.8	3.6	3.9	4.0	4.2	4.0	3.8
Below Normal (13%)	3.6	3.7	3.9	3.9	3.9	3.5	3.5	3.7	4.0	4.1	4.0	3.9
Dry (24%)	3.6	3.6	3.8	3.8	3.8	3.6	3.5	3.7	4.0	4.1	4.0	3.8
Critical (15%)	3.7	3.7	3.9	3.8	3.8	3.5	3.5	3.7	4.0	4.1	4.0	3.8

Alternative 3

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.9	4.0	4.5	4.7	4.7	4.3	4.0	4.1	4.2	4.3	4.1	4.0
20%	3.8	3.9	4.4	4.5	4.5	4.0	3.8	4.0	4.1	4.2	4.1	3.9
30%	3.7	3.8	4.1	4.2	4.3	3.9	3.7	3.9	4.1	4.2	4.1	3.9
40%	3.7	3.8	4.0	4.0	4.1	3.8	3.6	3.8	4.1	4.2	4.0	3.9
50%	3.6	3.7	3.9	4.0	4.0	3.7	3.5	3.8	4.0	4.2	4.0	3.8
60%	3.6	3.7	3.8	3.9	3.9	3.6	3.5	3.7	4.0	4.1	4.0	3.8
70%	3.5	3.6	3.8	3.8	3.8	3.5	3.4	3.7	3.9	4.1	3.9	3.8
80%	3.5	3.6	3.7	3.7	3.7	3.4	3.3	3.7	3.9	4.1	3.9	3.7
90%	3.5	3.5	3.6	3.7	3.5	3.3	3.3	3.6	3.9	4.0	3.9	3.7
Long Term												
Full Simulation Period ^b	3.6	3.7	4.0	4.1	4.1	3.7	3.6	3.8	4.0	4.2	4.0	3.8
Water Year Types ^c												
Wet (32%)	3.7	3.8	4.3	4.5	4.4	4.0	3.8	3.9	4.1	4.2	4.0	3.9
Above Normal (16%)	3.6	3.8	4.0	4.2	4.3	3.8	3.6	3.8	4.0	4.2	4.0	3.8
Below Normal (13%)	3.6	3.7	3.9	3.9	3.9	3.5	3.5	3.7	4.0	4.2	4.0	3.9
Dry (24%)	3.6	3.6	3.8	3.8	3.8	3.6	3.5	3.7	4.0	4.1	4.0	3.8
Critical (15%)	3.7	3.7	3.9	3.8	3.8	3.5	3.5	3.7	4.0	4.1	4.0	3.8

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
30%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-45-1-6. Sacramento River at Rio Vista, Monthly Averaged Daily Maximum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.9	4.0	4.5	4.7	4.7	4.3	4.0	4.1	4.2	4.2	4.1	4.0
20%	3.8	3.9	4.4	4.5	4.5	4.0	3.8	4.0	4.1	4.2	4.1	3.9
30%	3.7	3.8	4.0	4.2	4.3	3.9	3.7	3.9	4.1	4.2	4.1	3.9
40%	3.7	3.8	4.0	4.0	4.1	3.8	3.6	3.8	4.1	4.2	4.0	3.9
50%	3.6	3.7	3.9	4.0	4.0	3.7	3.6	3.8	4.0	4.2	4.0	3.8
60%	3.6	3.7	3.8	3.9	3.9	3.6	3.5	3.7	4.0	4.1	4.0	3.8
70%	3.5	3.6	3.8	3.8	3.8	3.5	3.4	3.7	3.9	4.1	3.9	3.8
80%	3.5	3.6	3.7	3.7	3.7	3.4	3.3	3.7	3.9	4.1	3.9	3.7
90%	3.5	3.5	3.6	3.7	3.5	3.3	3.3	3.6	3.9	4.0	3.9	3.7
Long Term												
Full Simulation Period ^b	3.6	3.7	4.0	4.1	4.1	3.7	3.6	3.8	4.0	4.1	4.0	3.8
Water Year Types ^c												
Wet (32%)	3.7	3.8	4.3	4.4	4.4	4.1	3.8	3.9	4.1	4.2	4.0	3.9
Above Normal (16%)	3.6	3.8	4.0	4.2	4.3	3.8	3.6	3.9	4.0	4.2	4.0	3.8
Below Normal (13%)	3.6	3.7	3.9	3.9	3.9	3.5	3.5	3.7	4.0	4.1	4.0	3.9
Dry (24%)	3.6	3.6	3.8	3.8	3.8	3.6	3.5	3.7	4.0	4.1	4.0	3.8
Critical (15%)	3.7	3.7	3.9	3.8	3.8	3.5	3.5	3.7	4.0	4.1	4.0	3.8

Alternative 5

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.9	4.0	4.5	4.7	4.7	4.3	4.0	4.1	4.2	4.3	4.2	4.1
20%	3.8	3.9	4.3	4.5	4.5	4.0	3.8	4.0	4.1	4.2	4.1	4.0
30%	3.7	3.8	4.1	4.2	4.3	3.9	3.7	3.9	4.1	4.2	4.1	4.0
40%	3.7	3.8	4.0	4.1	4.1	3.8	3.6	3.8	4.1	4.2	4.0	3.9
50%	3.6	3.7	3.9	4.0	4.0	3.7	3.6	3.8	4.0	4.2	4.0	3.9
60%	3.6	3.7	3.9	3.9	3.9	3.6	3.5	3.7	4.0	4.1	4.0	3.8
70%	3.5	3.6	3.8	3.8	3.8	3.5	3.4	3.7	3.9	4.1	3.9	3.8
80%	3.5	3.6	3.8	3.7	3.7	3.4	3.4	3.6	3.9	4.1	3.9	3.8
90%	3.5	3.5	3.6	3.7	3.5	3.3	3.3	3.6	3.8	4.0	3.9	3.7
Long Term												
Full Simulation Period ^b	3.6	3.8	4.0	4.1	4.1	3.7	3.6	3.8	4.0	4.2	4.0	3.9
Water Year Types ^c												
Wet (32%)	3.7	3.9	4.3	4.4	4.4	4.0	3.8	4.0	4.1	4.2	4.0	4.1
Above Normal (16%)	3.6	3.8	4.0	4.2	4.3	3.8	3.6	3.8	4.0	4.2	4.0	3.8
Below Normal (13%)	3.6	3.7	3.9	3.9	3.9	3.5	3.5	3.7	4.0	4.2	4.0	3.9
Dry (24%)	3.6	3.6	3.8	3.8	3.8	3.6	3.5	3.7	4.0	4.1	4.0	3.8
Critical (15%)	3.7	3.7	3.9	3.8	3.8	3.5	3.5	3.7	4.0	4.1	4.0	3.8

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Maximum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
30%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0


a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-45-2-1. Sacramento River at Rio Vista, Monthly Averaged Daily Minimum Elevation, October

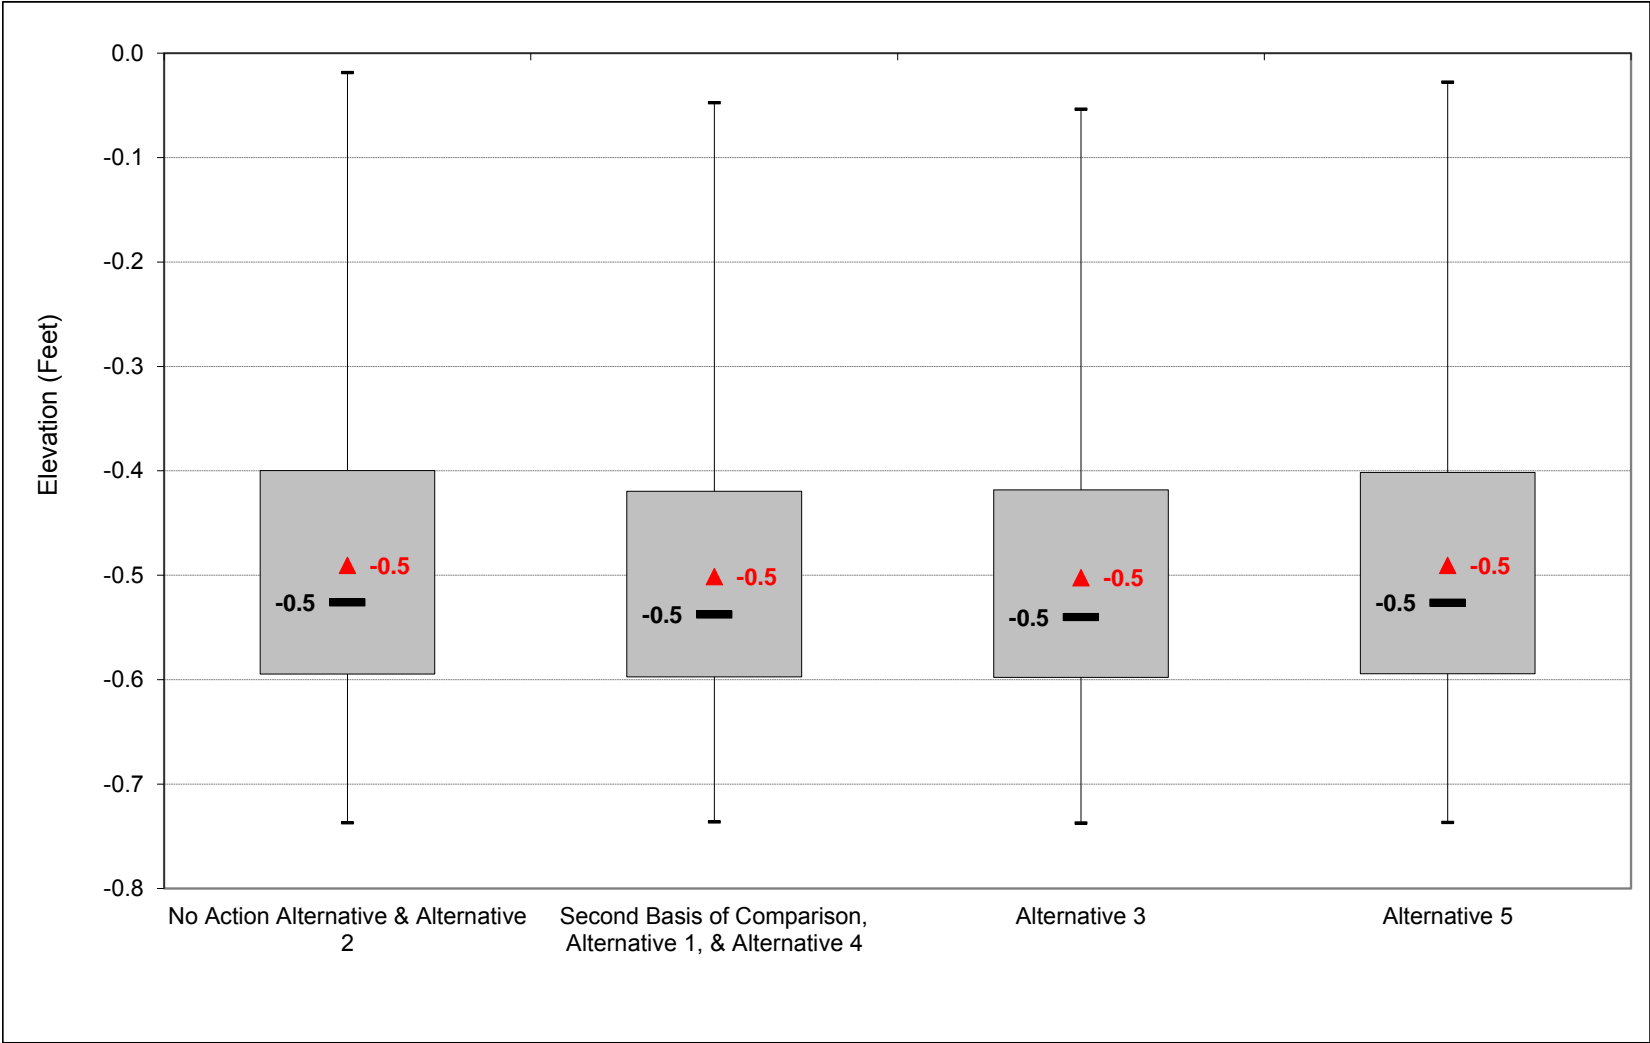


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-45-2-2. Sacramento River at Rio Vista, Monthly Averaged Daily Minimum Elevation, November

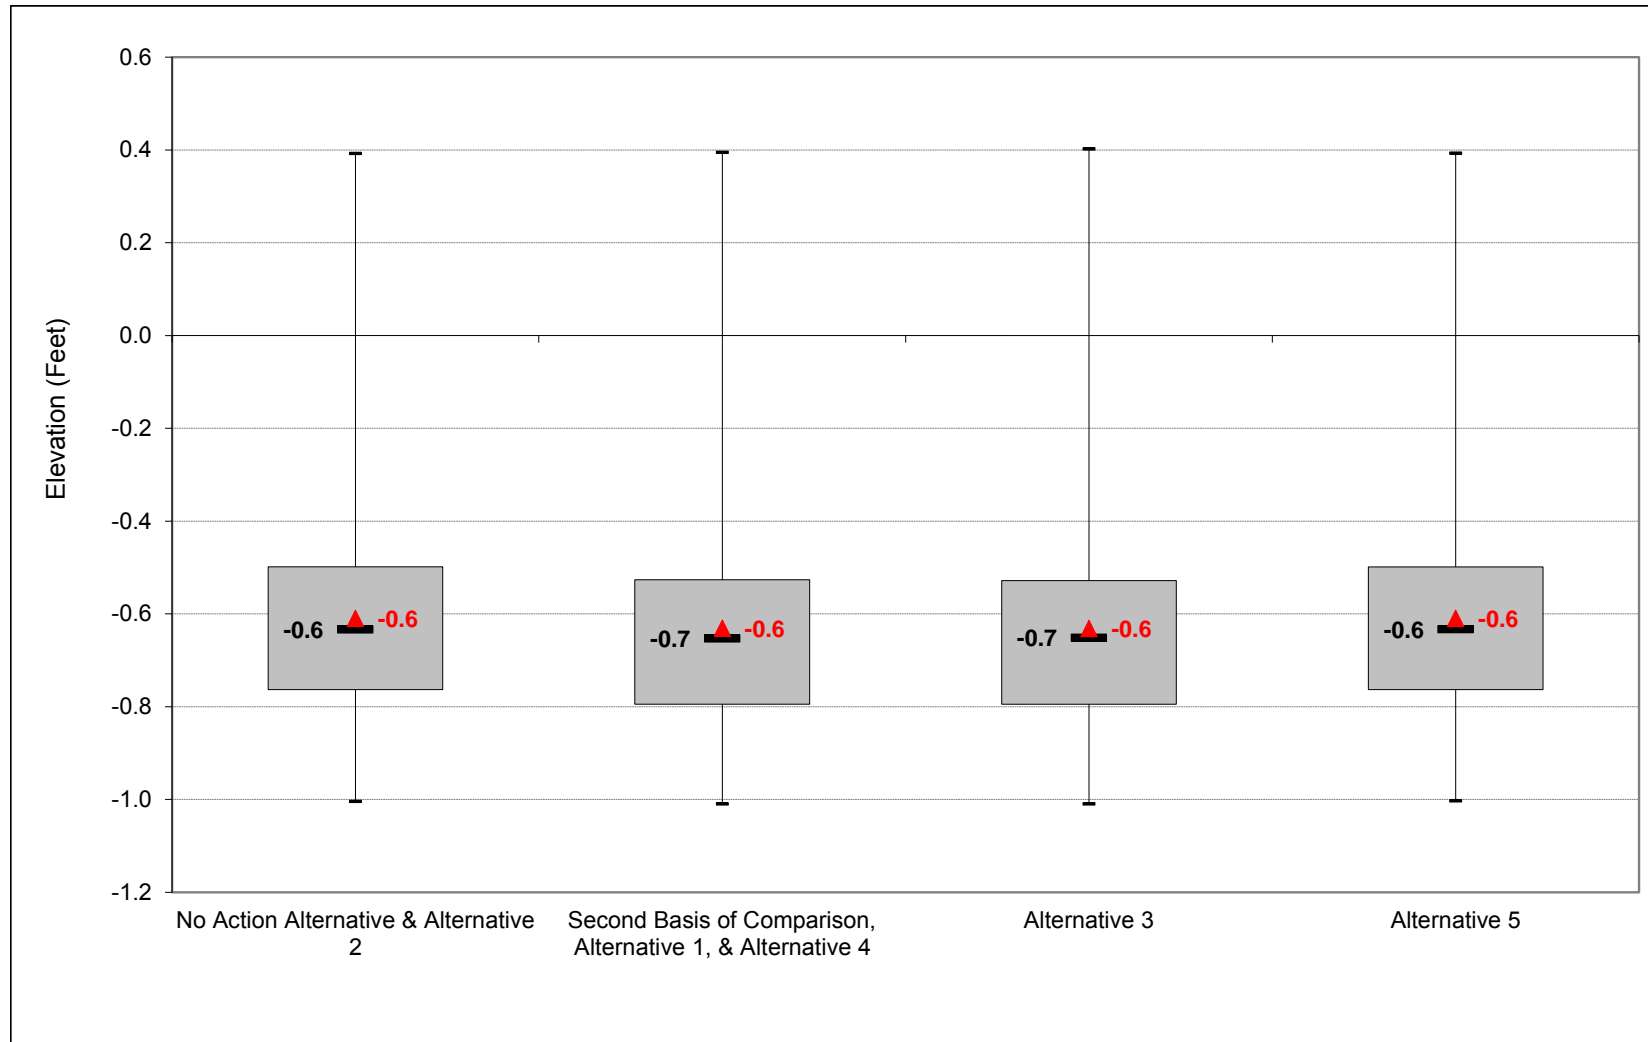


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-45-2-3. Sacramento River at Rio Vista, Monthly Averaged Daily Minimum Elevation, December

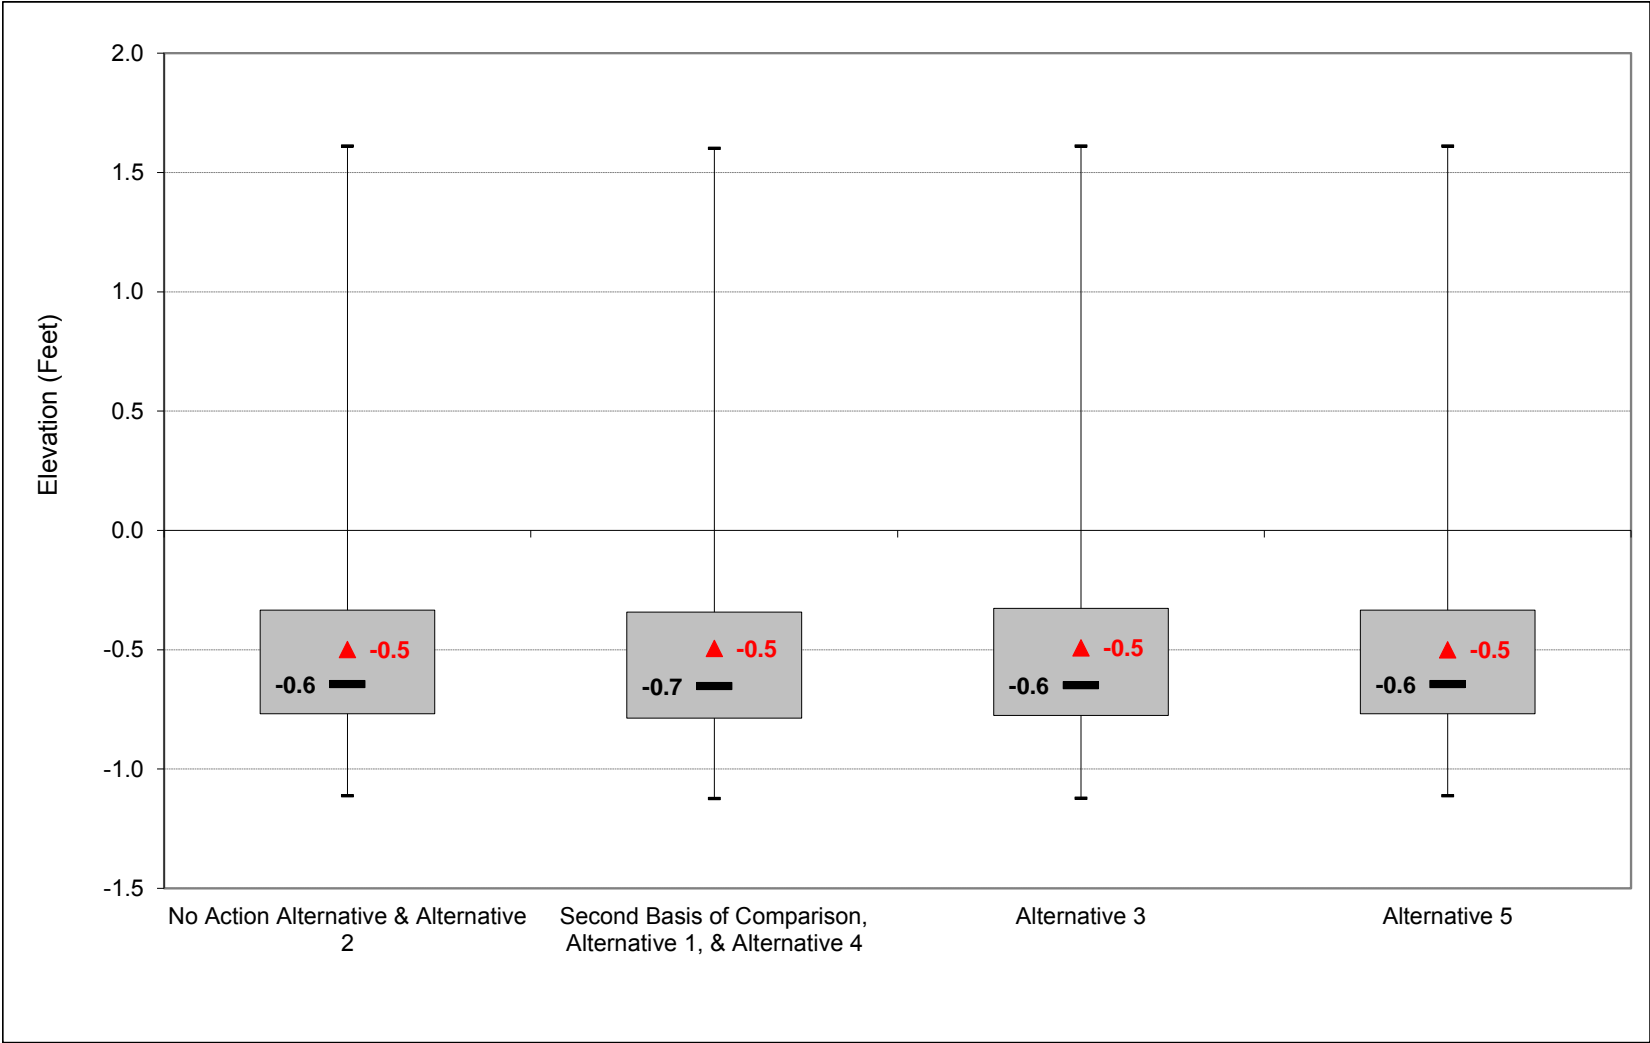


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-45-2-4. Sacramento River at Rio Vista, Monthly Averaged Daily Minimum Elevation, January

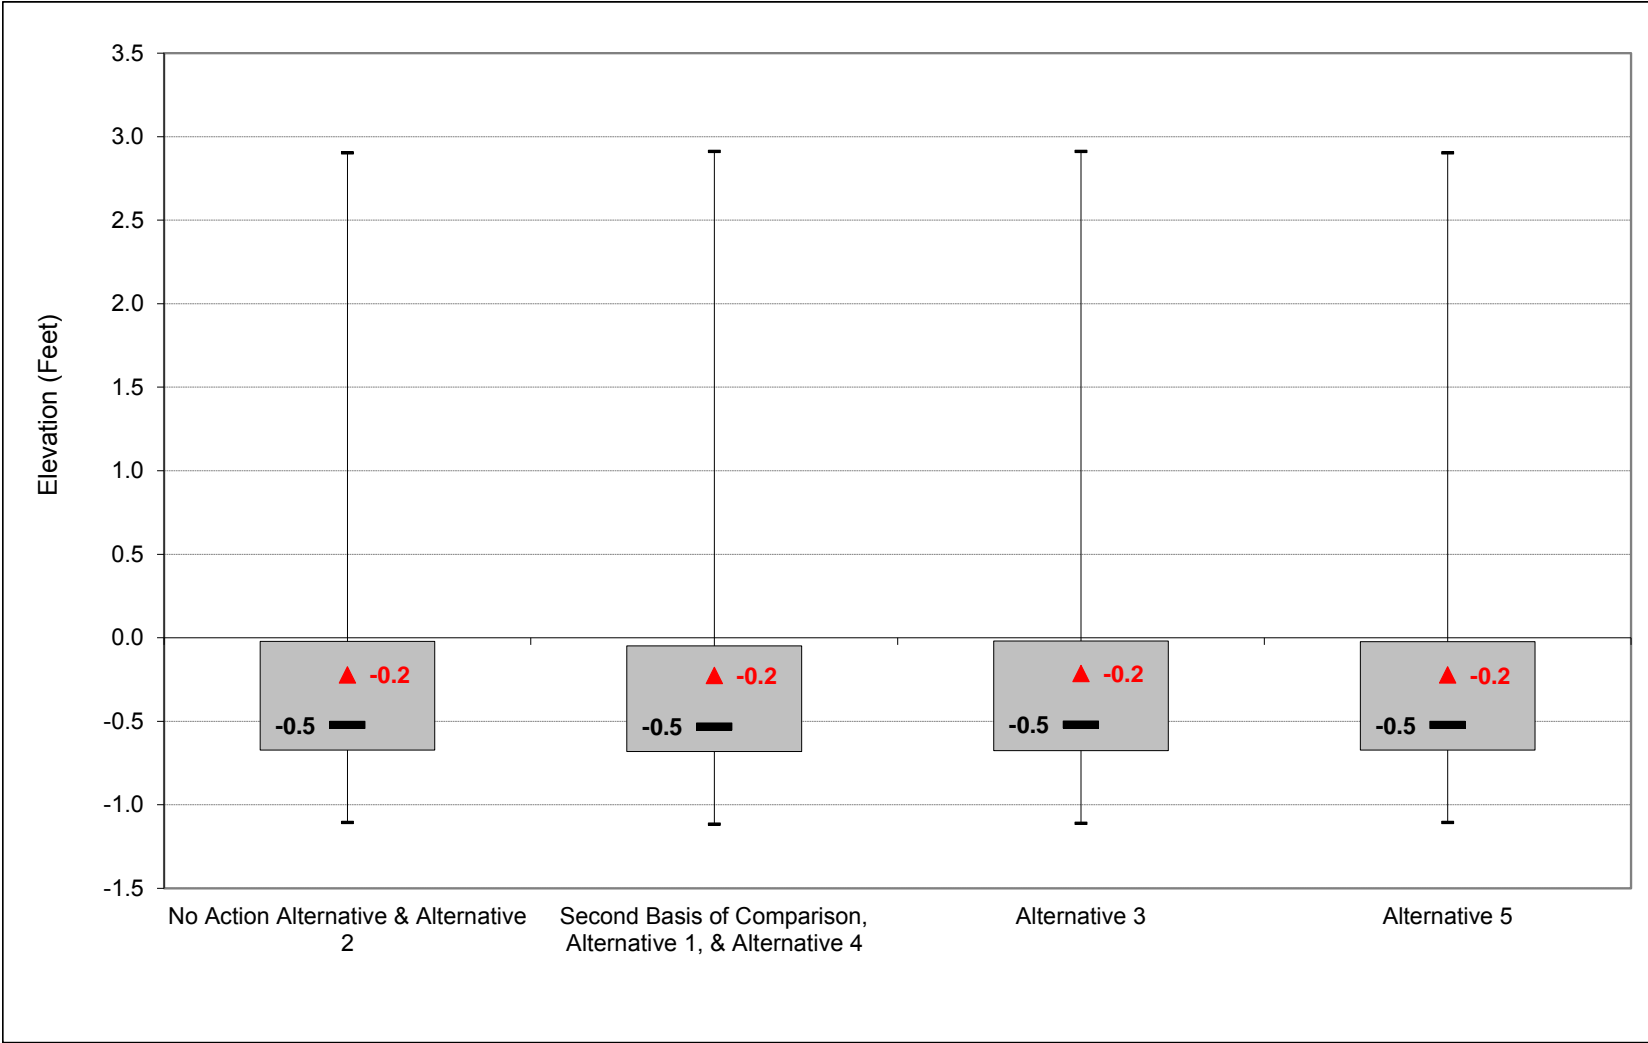


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-45-2-5. Sacramento River at Rio Vista, Monthly Averaged Daily Minimum Elevation, February

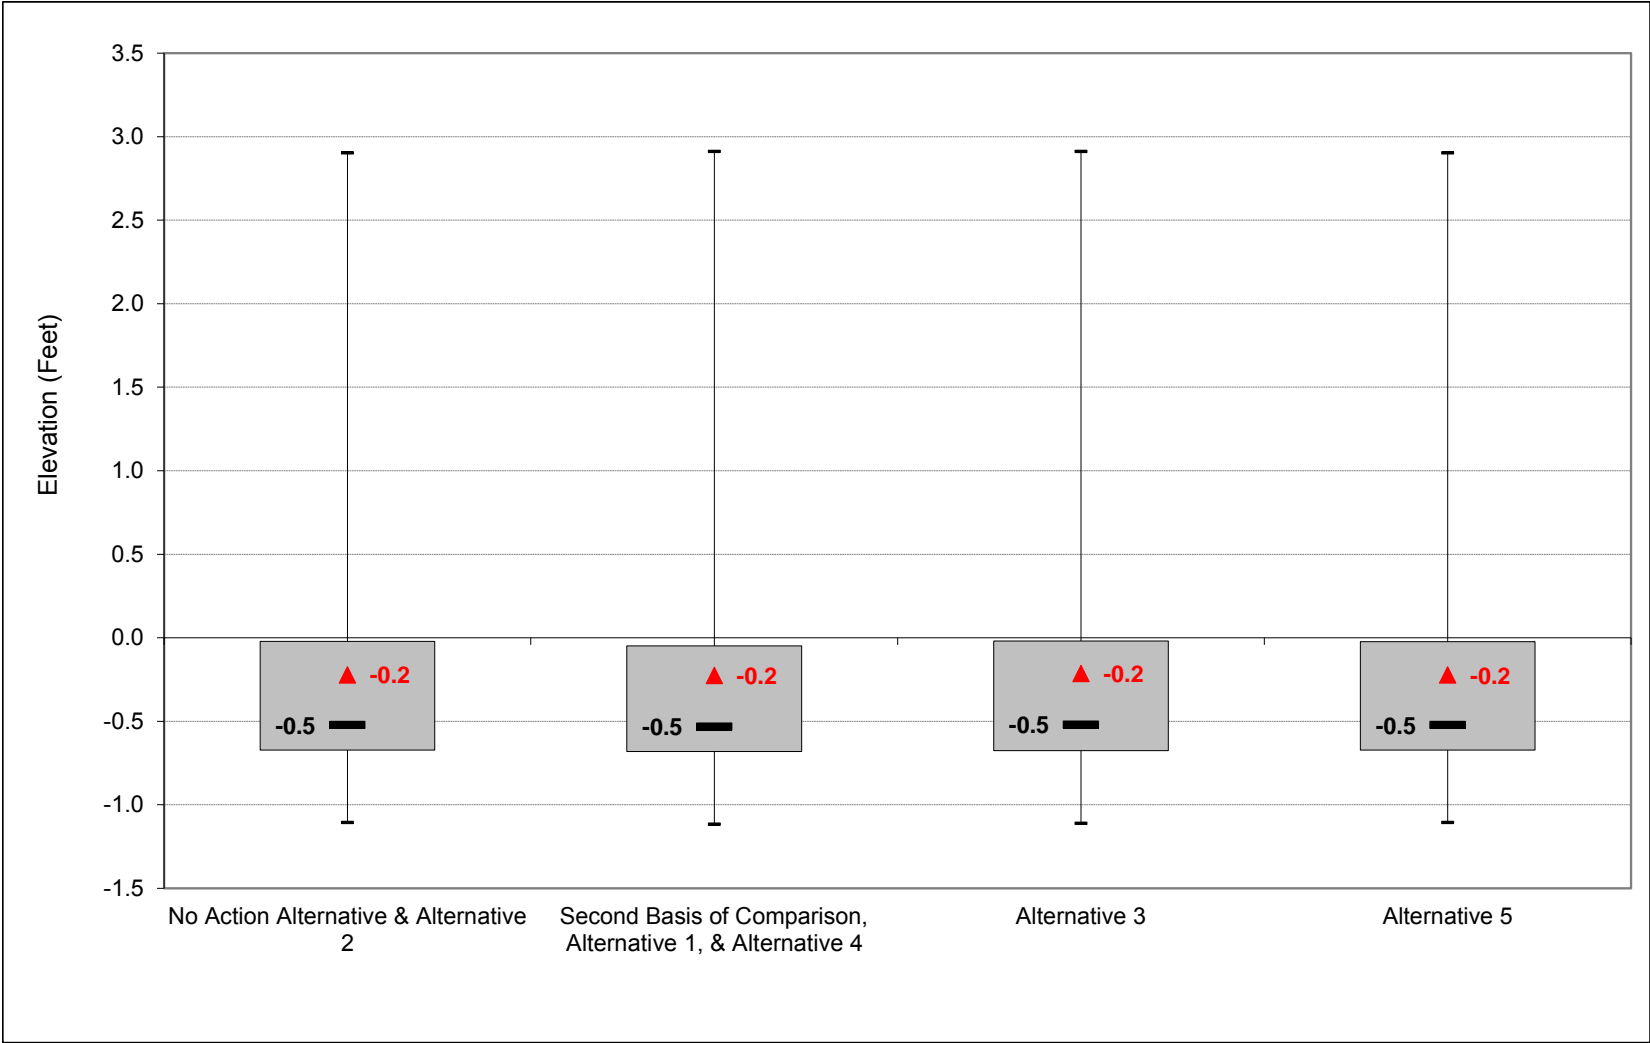


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-45-2-6. Sacramento River at Rio Vista, Monthly Averaged Daily Minimum Elevation, March

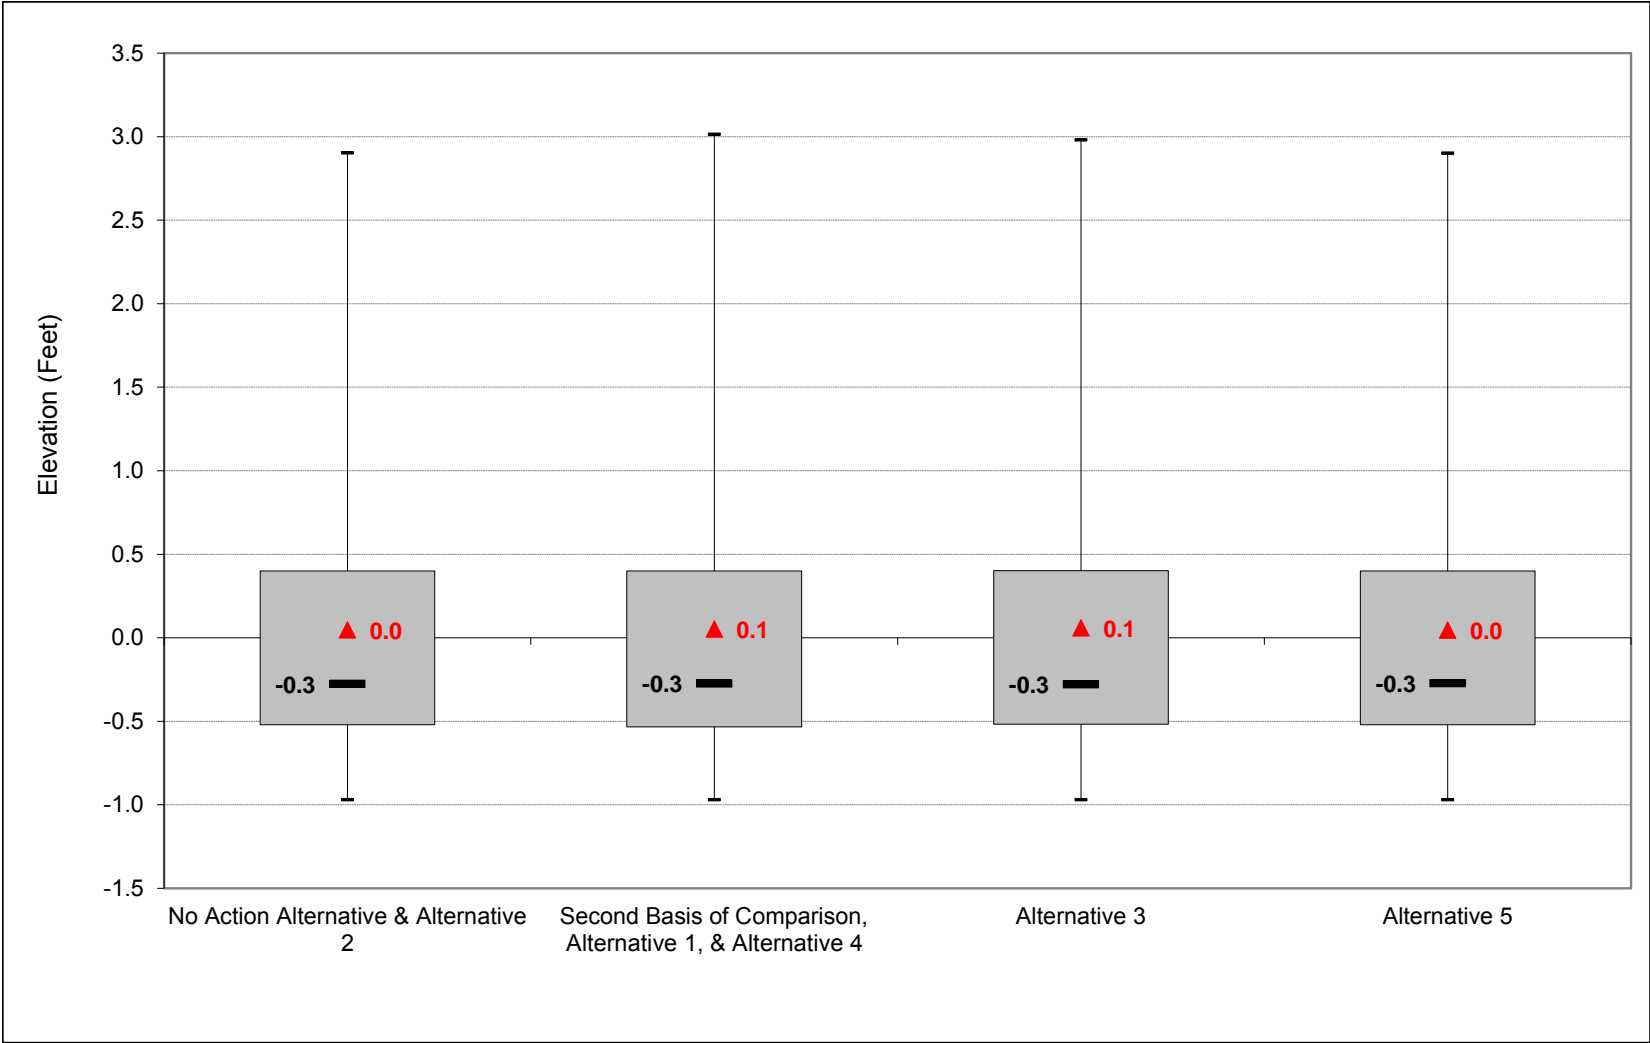


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-45-2-7. Sacramento River at Rio Vista, Monthly Averaged Daily Minimum Elevation, April

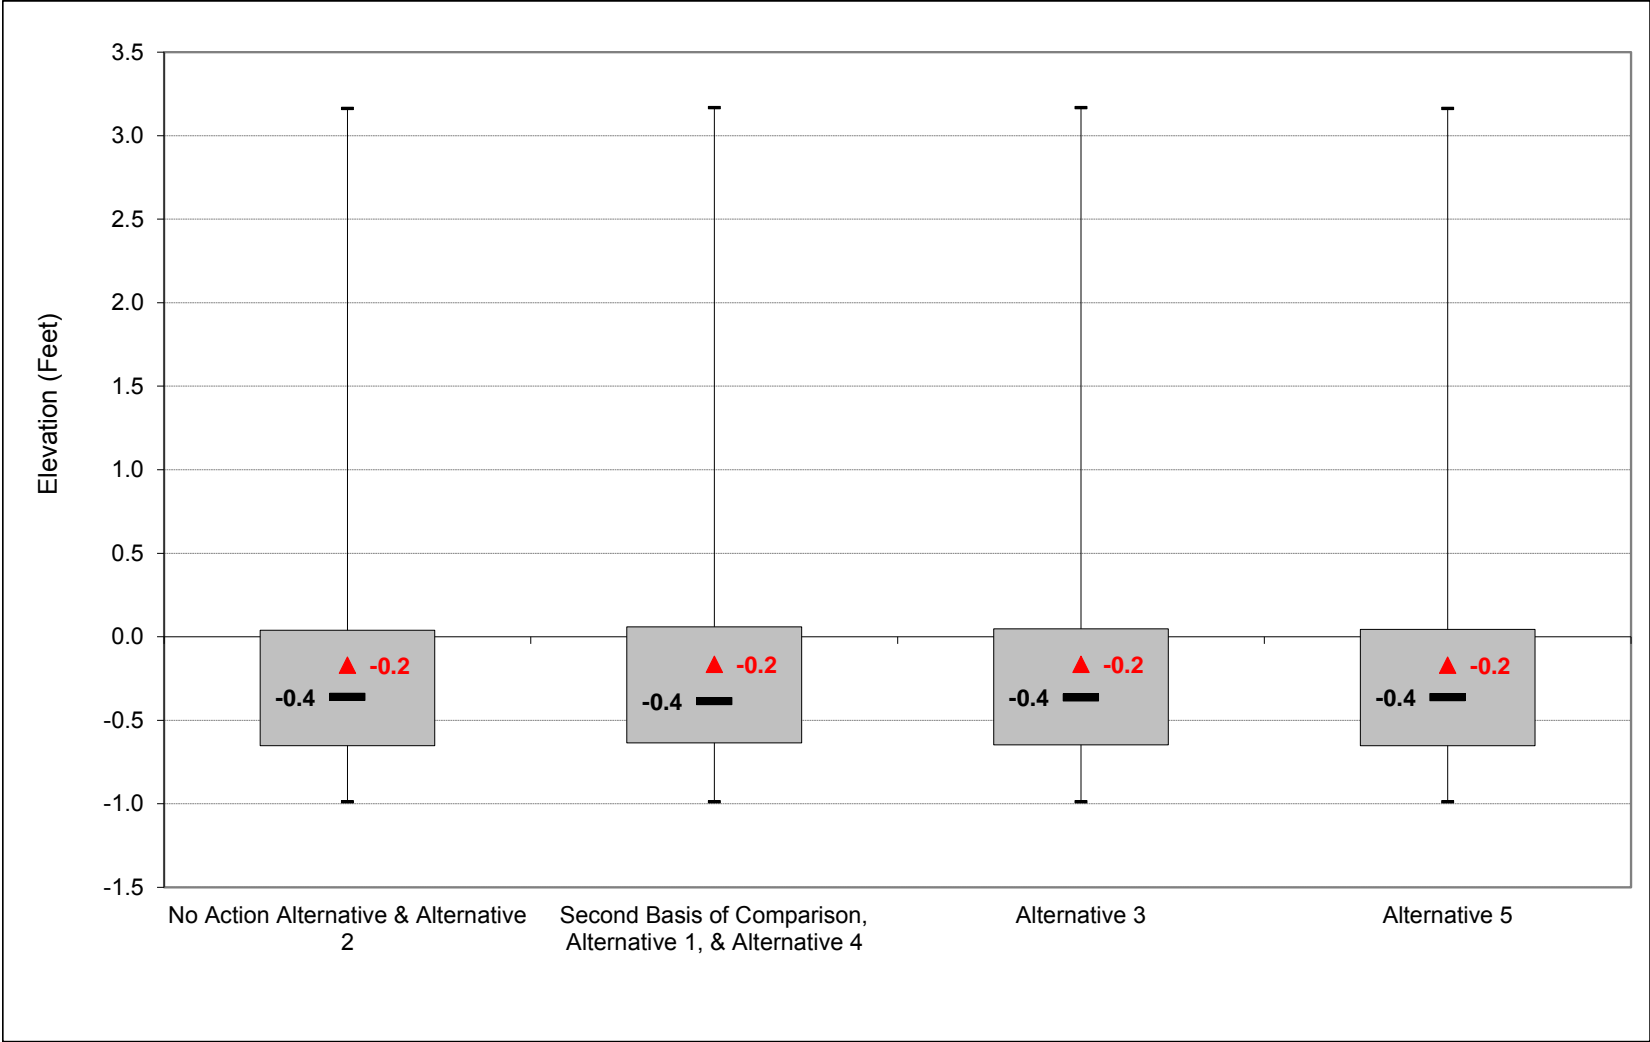


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-45-2-8. Sacramento River at Rio Vista, Monthly Averaged Daily Minimum Elevation, May

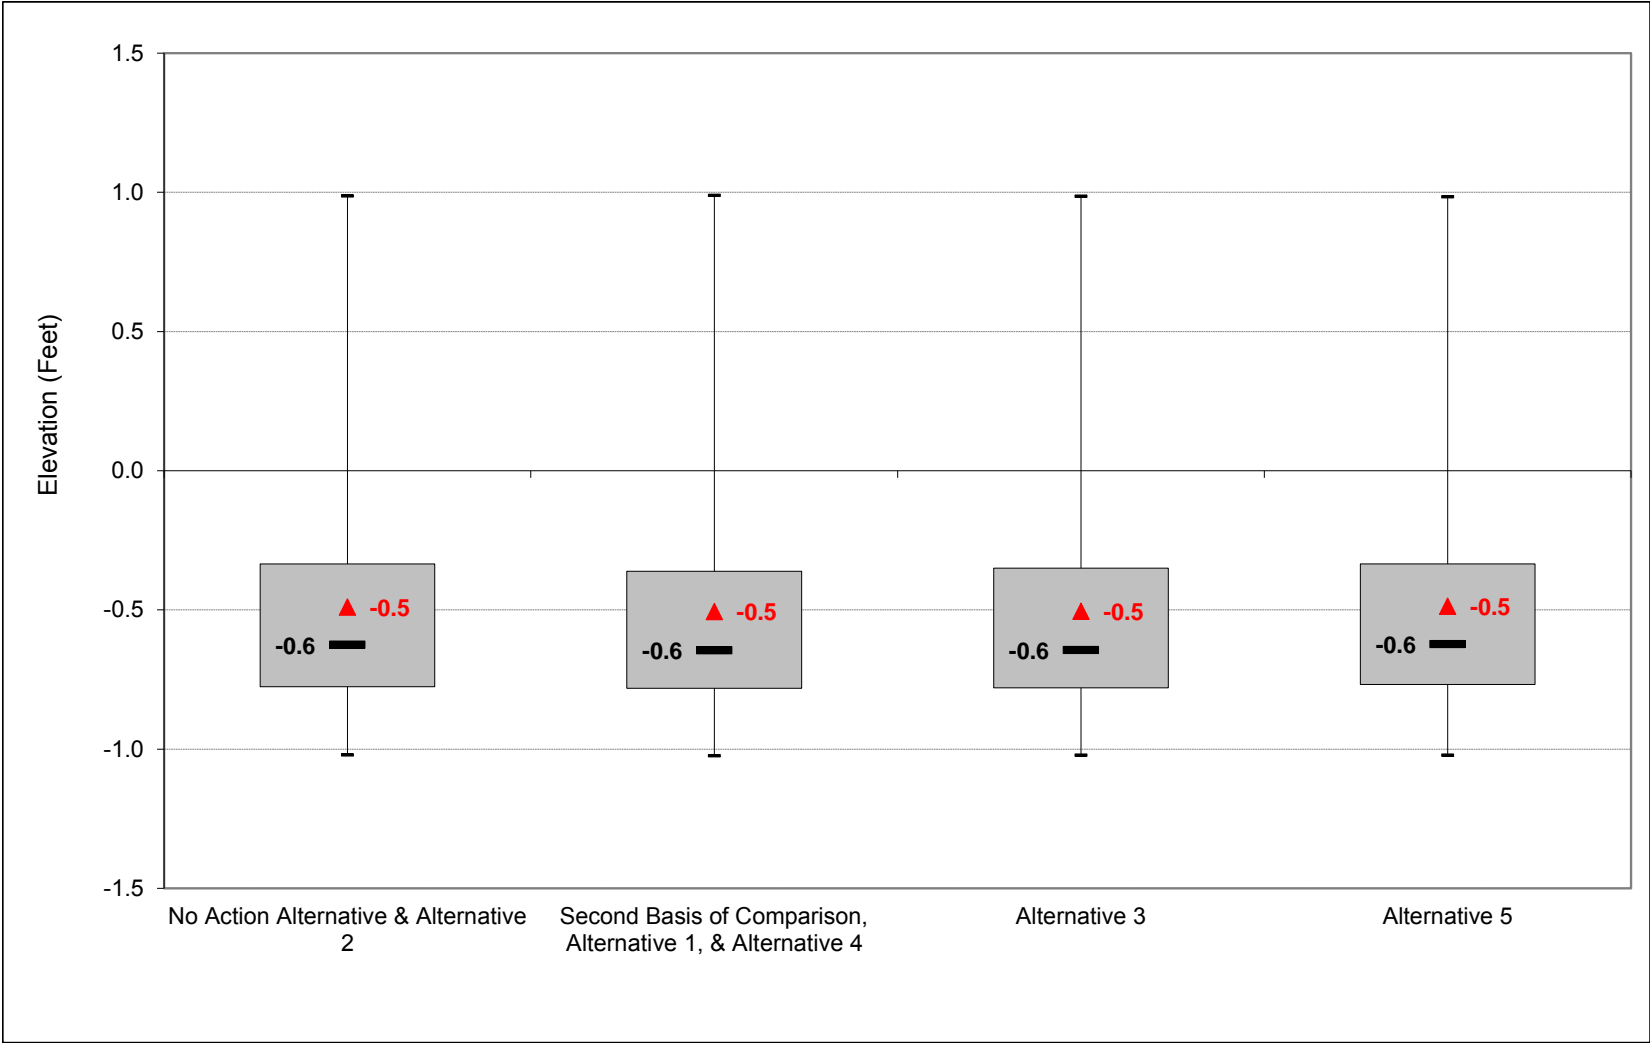


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-45-2-9. Sacramento River at Rio Vista, Monthly Averaged Daily Minimum Elevation, June

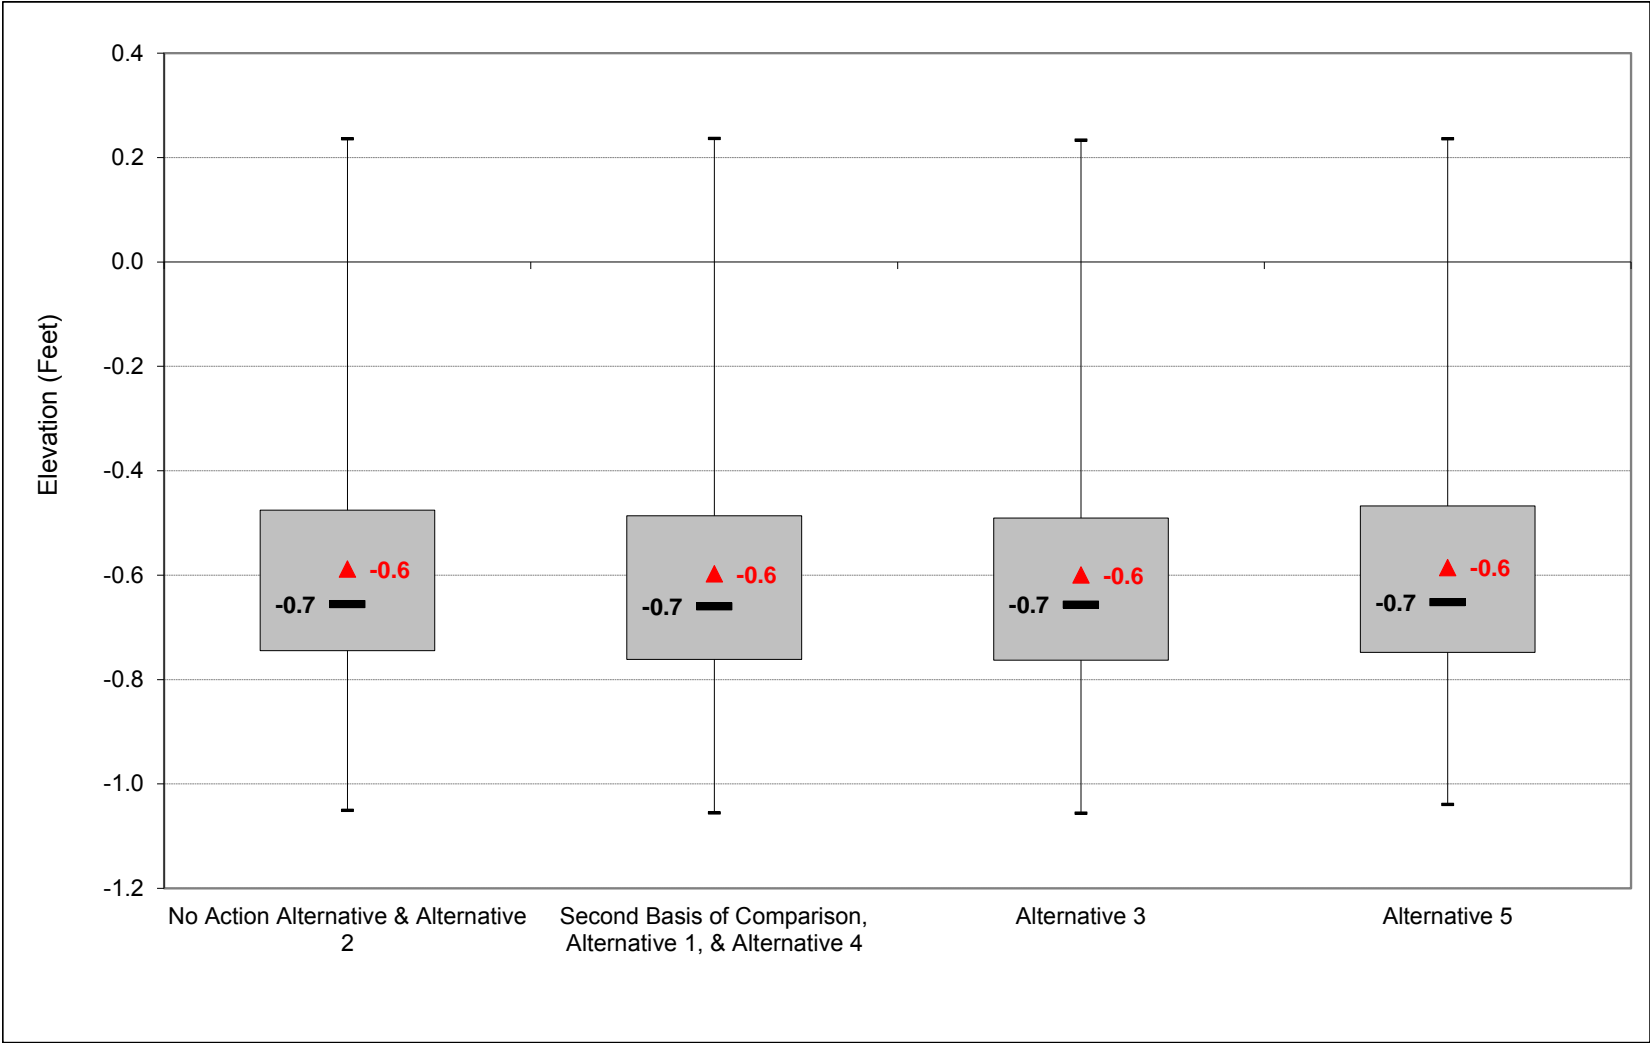


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-45-2-10. Sacramento River at Rio Vista, Monthly Averaged Daily Minimum Elevation, July

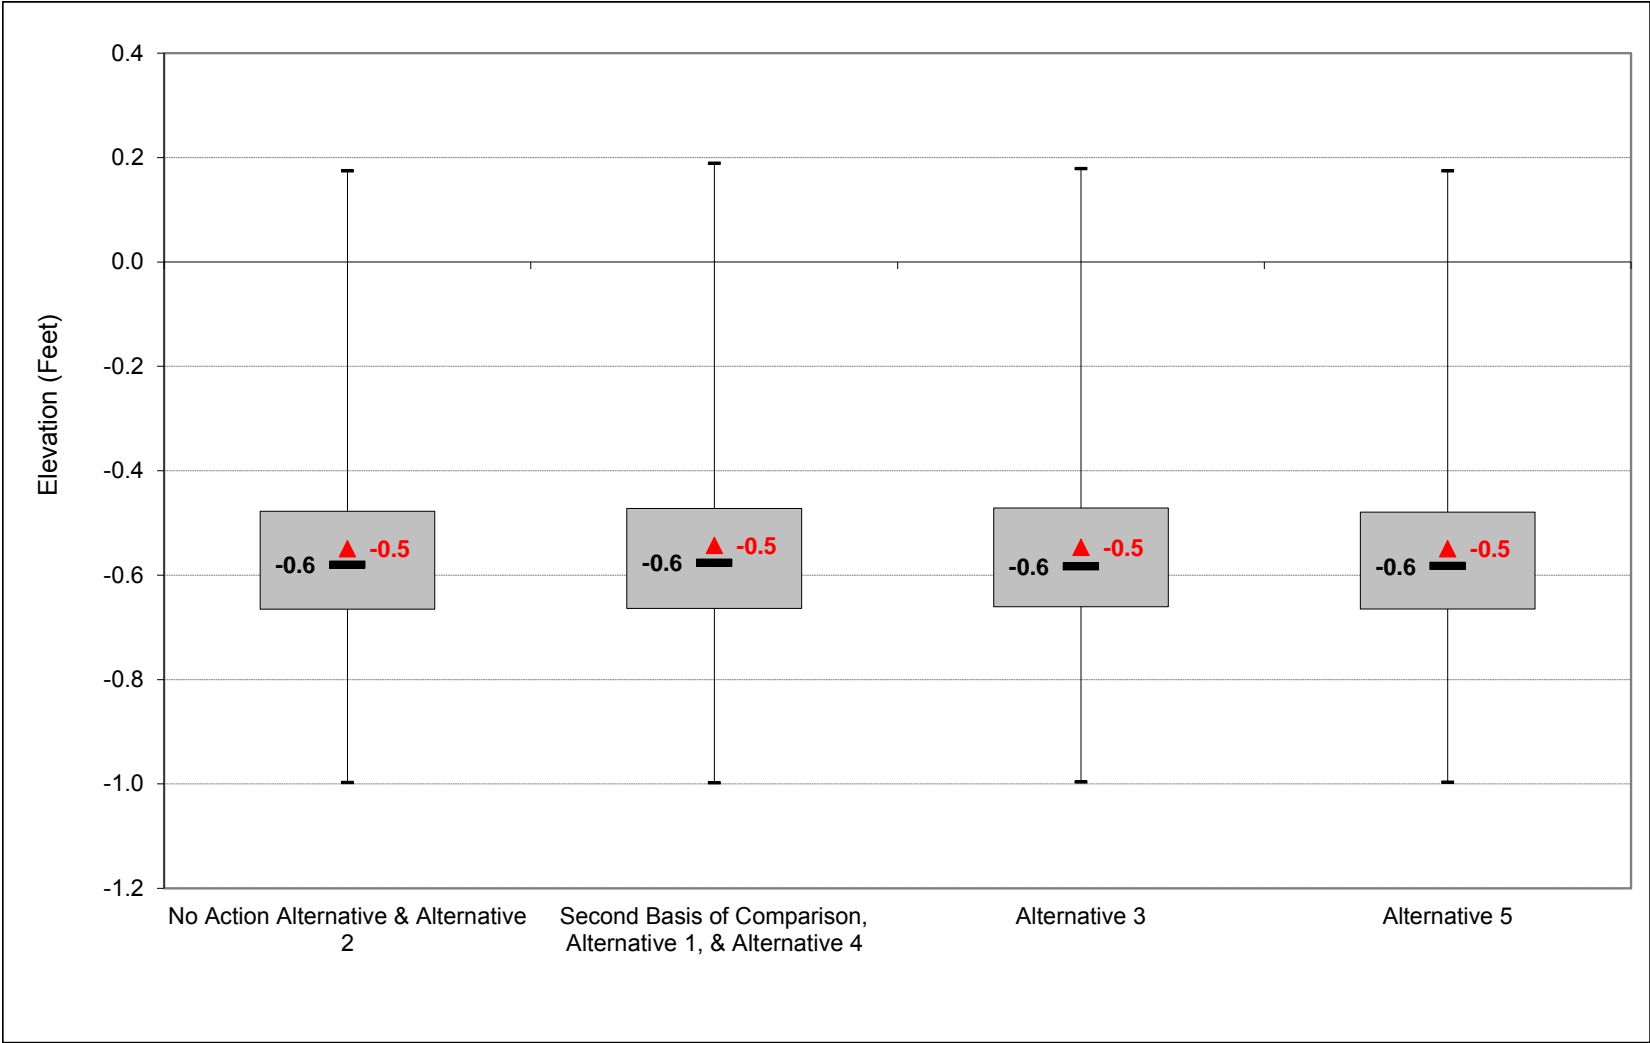


Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-45-2-11. Sacramento River at Rio Vista, Monthly Averaged Daily Minimum Elevation, August

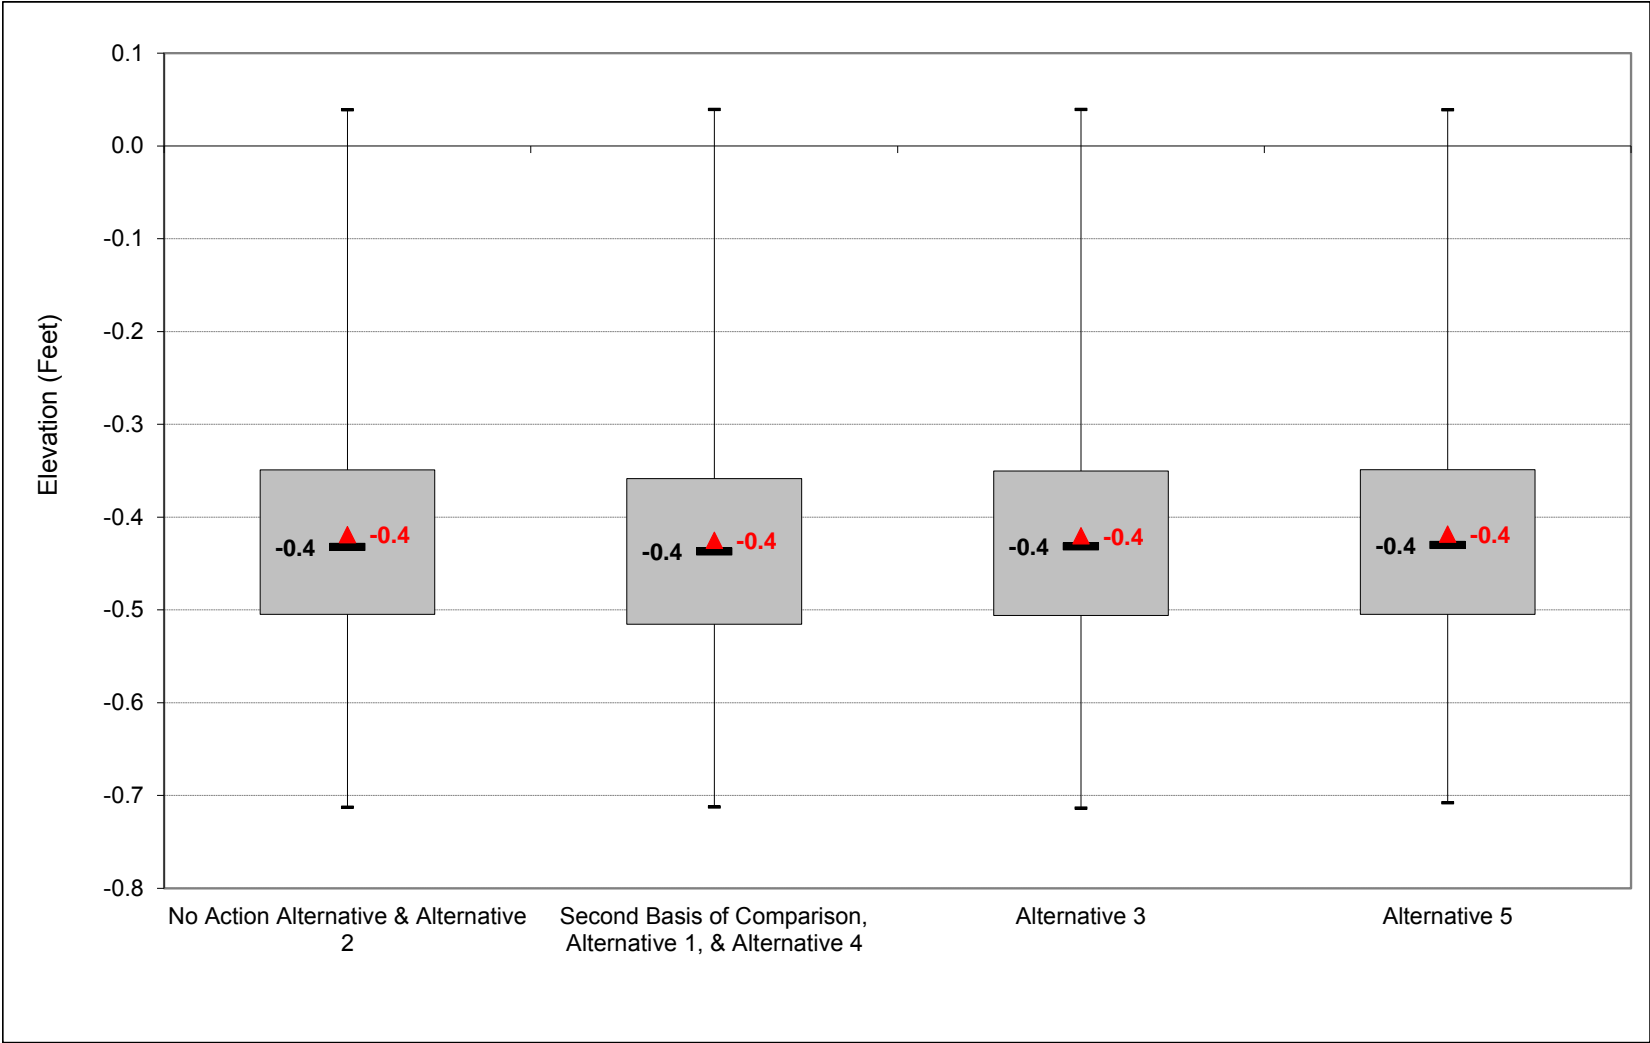

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure C-45-2-12. Sacramento River at Rio Vista, Monthly Averaged Daily Minimum Elevation, September

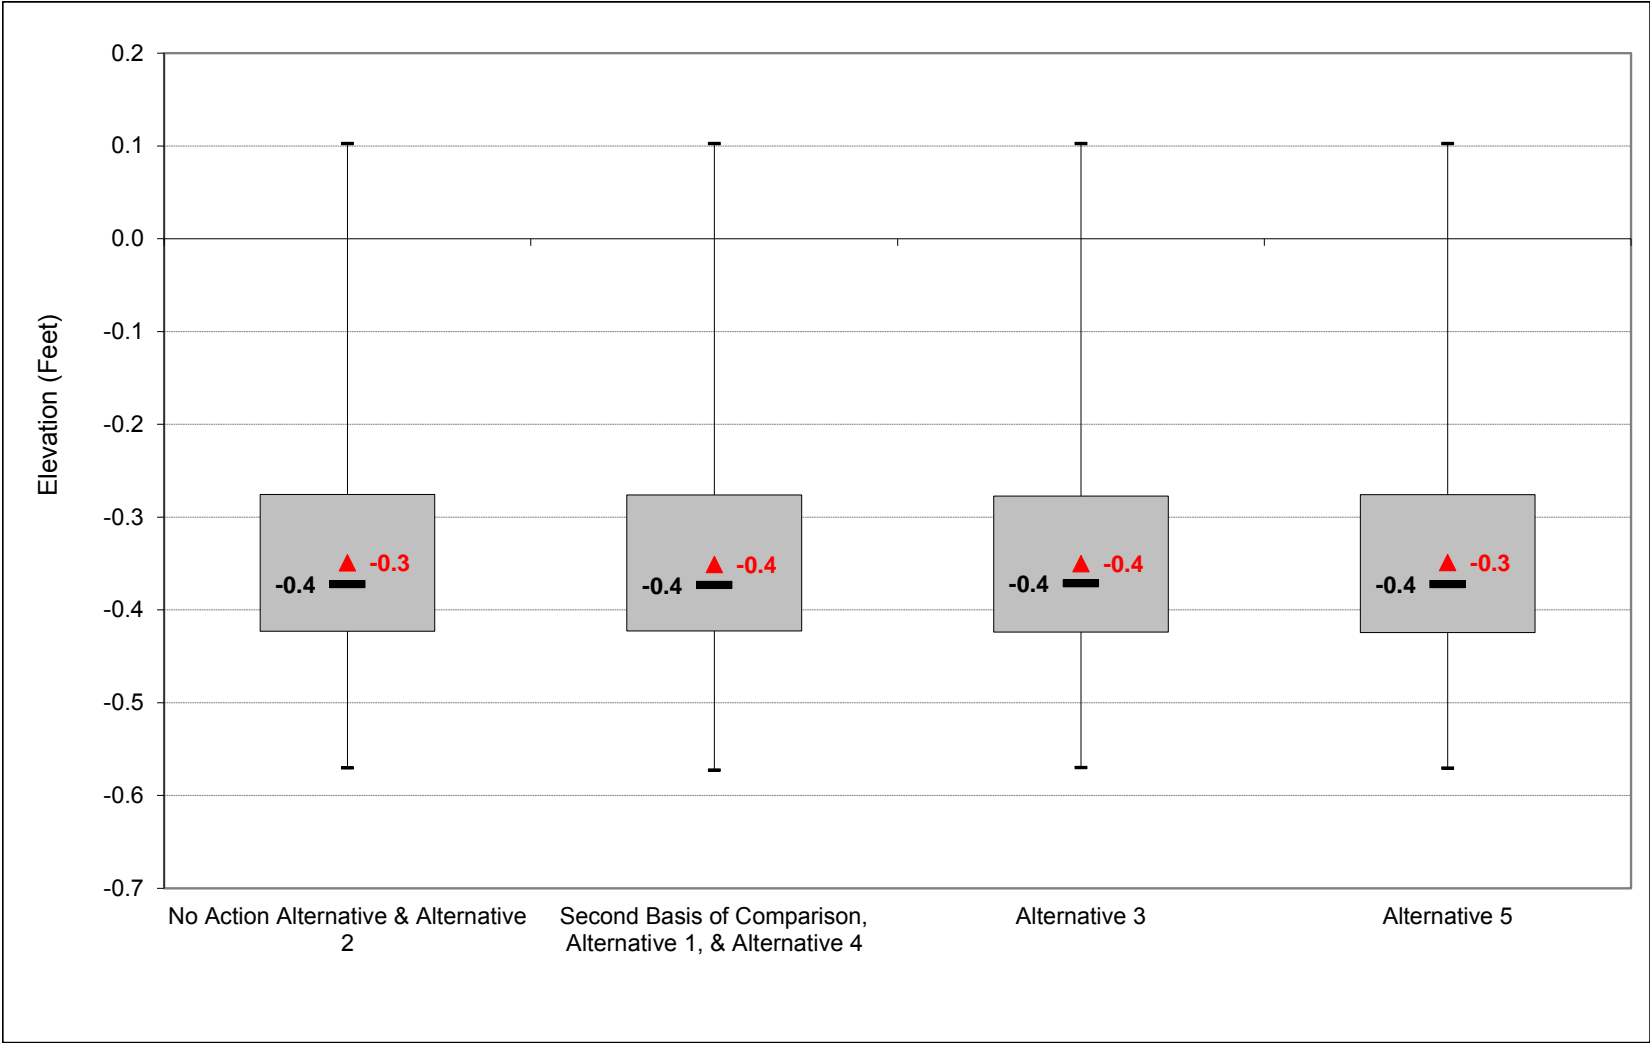

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-45-2-1. Sacramento River at Rio Vista, Monthly Averaged Daily Minimum Elevation

No Action Alternative												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-0.3	-0.4	0.2	0.8	1.3	0.7	0.1	-0.2	-0.4	-0.2	-0.2	-0.1
20%	-0.4	-0.5	-0.2	0.3	0.5	0.1	-0.2	-0.4	-0.5	-0.3	-0.3	-0.1
30%	-0.4	-0.5	-0.5	-0.2	0.3	-0.1	-0.4	-0.5	-0.5	-0.4	-0.3	-0.2
40%	-0.5	-0.6	-0.6	-0.4	0.1	-0.3	-0.5	-0.6	-0.5	-0.4	-0.3	-0.3
50%	-0.5	-0.6	-0.6	-0.5	-0.3	-0.4	-0.6	-0.7	-0.6	-0.4	-0.4	-0.3
60%	-0.6	-0.7	-0.7	-0.6	-0.4	-0.4	-0.7	-0.7	-0.6	-0.5	-0.4	-0.3
70%	-0.6	-0.7	-0.7	-0.6	-0.5	-0.5	-0.7	-0.7	-0.6	-0.5	-0.4	-0.3
80%	-0.6	-0.8	-0.8	-0.7	-0.6	-0.7	-0.8	-0.8	-0.7	-0.5	-0.4	-0.4
90%	-0.7	-0.8	-0.9	-0.8	-0.7	-0.7	-0.8	-0.8	-0.7	-0.6	-0.5	-0.4
Long Term												
Full Simulation Period ^b	-0.5	-0.6	-0.5	-0.2	0.0	-0.2	-0.5	-0.6	-0.5	-0.4	-0.3	-0.3
Water Year Types^c												
Wet (32%)	-0.4	-0.5	-0.2	0.4	0.7	0.4	-0.2	-0.4	-0.4	-0.3	-0.3	-0.1
Above Normal (16%)	-0.5	-0.6	-0.5	-0.1	0.3	-0.1	-0.5	-0.6	-0.6	-0.4	-0.3	-0.3
Below Normal (13%)	-0.5	-0.6	-0.6	-0.6	-0.3	-0.6	-0.7	-0.7	-0.6	-0.4	-0.3	-0.3
Dry (24%)	-0.5	-0.7	-0.8	-0.6	-0.4	-0.4	-0.7	-0.7	-0.6	-0.5	-0.4	-0.4
Critical (15%)	-0.5	-0.7	-0.7	-0.7	-0.5	-0.6	-0.7	-0.8	-0.7	-0.5	-0.4	-0.4

Alternative 1												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-0.3	-0.4	0.3	0.8	1.4	0.7	0.0	-0.2	-0.4	-0.3	-0.2	-0.1
20%	-0.4	-0.5	-0.2	0.3	0.5	0.1	-0.2	-0.4	-0.4	-0.3	-0.3	-0.2
30%	-0.5	-0.6	-0.5	-0.2	0.3	0.0	-0.4	-0.5	-0.5	-0.4	-0.3	-0.3
40%	-0.5	-0.6	-0.6	-0.4	0.1	-0.3	-0.6	-0.6	-0.5	-0.4	-0.3	-0.3
50%	-0.5	-0.7	-0.7	-0.5	-0.3	-0.4	-0.6	-0.7	-0.6	-0.4	-0.4	-0.3
60%	-0.6	-0.7	-0.7	-0.6	-0.4	-0.4	-0.7	-0.7	-0.6	-0.5	-0.4	-0.3
70%	-0.6	-0.8	-0.7	-0.7	-0.5	-0.5	-0.8	-0.7	-0.6	-0.5	-0.4	-0.4
80%	-0.6	-0.8	-0.8	-0.7	-0.6	-0.7	-0.8	-0.8	-0.7	-0.5	-0.4	-0.4
90%	-0.7	-0.9	-0.9	-0.8	-0.7	-0.7	-0.9	-0.8	-0.7	-0.6	-0.5	-0.5
Long Term												
Full Simulation Period ^b	-0.5	-0.6	-0.5	-0.2	0.1	-0.2	-0.5	-0.6	-0.5	-0.4	-0.4	-0.3
Water Year Types^c												
Wet (32%)	-0.4	-0.5	-0.1	0.4	0.7	0.4	-0.2	-0.4	-0.4	-0.3	-0.3	-0.2
Above Normal (16%)	-0.5	-0.6	-0.5	-0.1	0.3	0.0	-0.5	-0.6	-0.6	-0.4	-0.3	-0.3
Below Normal (13%)	-0.5	-0.6	-0.6	-0.6	-0.3	-0.6	-0.7	-0.7	-0.6	-0.4	-0.3	-0.3
Dry (24%)	-0.5	-0.7	-0.8	-0.7	-0.4	-0.4	-0.7	-0.7	-0.6	-0.5	-0.4	-0.4
Critical (15%)	-0.5	-0.7	-0.7	-0.7	-0.5	-0.6	-0.7	-0.8	-0.7	-0.5	-0.4	-0.4

Alternative 1 minus No Action Alternative												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.0	0.0	0.1	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
30%	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-45-2.2. Sacramento River at Rio Vista, Monthly Averaged Daily Minimum Elevation

No Action Alternative												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.3	-0.4	0.2	0.8	1.3	0.7	0.1	-0.2	-0.4	-0.2	-0.2	-0.1
20%	-0.4	-0.5	-0.2	0.3	0.5	0.1	-0.2	-0.4	-0.5	-0.3	-0.3	-0.1
30%	-0.4	-0.5	-0.5	-0.2	0.3	-0.1	-0.4	-0.5	-0.5	-0.4	-0.3	-0.2
40%	-0.5	-0.6	-0.6	-0.4	0.1	-0.3	-0.5	-0.6	-0.5	-0.4	-0.3	-0.3
50%	-0.5	-0.6	-0.6	-0.5	-0.3	-0.4	-0.6	-0.7	-0.6	-0.4	-0.4	-0.3
60%	-0.6	-0.7	-0.7	-0.6	-0.4	-0.4	-0.7	-0.7	-0.6	-0.5	-0.4	-0.3
70%	-0.6	-0.7	-0.7	-0.6	-0.5	-0.5	-0.7	-0.7	-0.6	-0.5	-0.4	-0.3
80%	-0.6	-0.8	-0.8	-0.7	-0.6	-0.7	-0.8	-0.8	-0.7	-0.5	-0.4	-0.4
90%	-0.7	-0.8	-0.9	-0.8	-0.7	-0.7	-0.8	-0.8	-0.7	-0.6	-0.5	-0.4
Long Term												
Full Simulation Period ^b	-0.5	-0.6	-0.5	-0.2	0.0	-0.2	-0.5	-0.6	-0.5	-0.4	-0.3	-0.3
Water Year Types ^c												
Wet (32%)	-0.4	-0.5	-0.2	0.4	0.7	0.4	-0.2	-0.4	-0.4	-0.3	-0.3	-0.1
Above Normal (16%)	-0.5	-0.6	-0.5	-0.1	0.3	-0.1	-0.5	-0.6	-0.6	-0.4	-0.3	-0.3
Below Normal (13%)	-0.5	-0.6	-0.6	-0.6	-0.3	-0.6	-0.7	-0.7	-0.6	-0.4	-0.3	-0.3
Dry (24%)	-0.5	-0.7	-0.8	-0.6	-0.4	-0.4	-0.7	-0.7	-0.6	-0.5	-0.4	-0.4
Critical (15%)	-0.5	-0.7	-0.7	-0.7	-0.5	-0.6	-0.7	-0.8	-0.7	-0.5	-0.4	-0.4

Alternative 3												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.3	-0.4	0.3	0.8	1.4	0.7	0.0	-0.2	-0.4	-0.2	-0.2	-0.1
20%	-0.4	-0.5	-0.2	0.4	0.5	0.1	-0.2	-0.4	-0.5	-0.3	-0.3	-0.2
30%	-0.5	-0.6	-0.5	-0.2	0.3	-0.1	-0.4	-0.5	-0.5	-0.4	-0.3	-0.3
40%	-0.5	-0.6	-0.6	-0.4	0.1	-0.3	-0.6	-0.6	-0.5	-0.4	-0.3	-0.3
50%	-0.5	-0.7	-0.6	-0.5	-0.3	-0.4	-0.6	-0.7	-0.6	-0.4	-0.4	-0.3
60%	-0.6	-0.7	-0.7	-0.6	-0.4	-0.4	-0.7	-0.7	-0.6	-0.5	-0.4	-0.3
70%	-0.6	-0.8	-0.7	-0.6	-0.5	-0.5	-0.8	-0.7	-0.6	-0.5	-0.4	-0.4
80%	-0.6	-0.8	-0.8	-0.7	-0.6	-0.7	-0.8	-0.8	-0.7	-0.5	-0.4	-0.4
90%	-0.7	-0.9	-0.9	-0.8	-0.7	-0.7	-0.9	-0.8	-0.7	-0.6	-0.5	-0.4
Long Term												
Full Simulation Period ^b	-0.5	-0.6	-0.5	-0.2	0.1	-0.2	-0.5	-0.6	-0.5	-0.4	-0.4	-0.3
Water Year Types ^c												
Wet (32%)	-0.4	-0.5	-0.1	0.4	0.7	0.4	-0.2	-0.4	-0.4	-0.3	-0.3	-0.2
Above Normal (16%)	-0.5	-0.6	-0.5	-0.1	0.3	0.0	-0.5	-0.6	-0.6	-0.4	-0.3	-0.3
Below Normal (13%)	-0.5	-0.7	-0.6	-0.6	-0.2	-0.6	-0.7	-0.7	-0.6	-0.4	-0.3	-0.3
Dry (24%)	-0.5	-0.7	-0.8	-0.6	-0.4	-0.4	-0.7	-0.7	-0.6	-0.5	-0.4	-0.4
Critical (15%)	-0.5	-0.7	-0.7	-0.7	-0.5	-0.6	-0.7	-0.8	-0.7	-0.5	-0.4	-0.4

Alternative 3 minus No Action Alternative												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.0	0.1	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
30%	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-45-2.3. Sacramento River at Rio Vista, Monthly Averaged Daily Minimum Elevation

No Action Alternative												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.3	-0.4	0.2	0.8	1.3	0.7	0.1	-0.2	-0.4	-0.2	-0.2	-0.1
20%	-0.4	-0.5	-0.2	0.3	0.5	0.1	-0.2	-0.4	-0.5	-0.3	-0.3	-0.1
30%	-0.4	-0.5	-0.5	-0.2	0.3	-0.1	-0.4	-0.5	-0.5	-0.4	-0.3	-0.2
40%	-0.5	-0.6	-0.6	-0.4	0.1	-0.3	-0.5	-0.6	-0.5	-0.4	-0.3	-0.3
50%	-0.5	-0.6	-0.6	-0.5	-0.3	-0.4	-0.6	-0.7	-0.6	-0.4	-0.4	-0.3
60%	-0.6	-0.7	-0.7	-0.6	-0.4	-0.4	-0.7	-0.7	-0.6	-0.5	-0.4	-0.3
70%	-0.6	-0.7	-0.7	-0.6	-0.5	-0.5	-0.7	-0.7	-0.6	-0.5	-0.4	-0.3
80%	-0.6	-0.8	-0.8	-0.7	-0.6	-0.7	-0.8	-0.8	-0.7	-0.5	-0.4	-0.4
90%	-0.7	-0.8	-0.9	-0.8	-0.7	-0.7	-0.8	-0.8	-0.7	-0.6	-0.5	-0.4
Long Term												
Full Simulation Period ^b	-0.5	-0.6	-0.5	-0.2	0.0	-0.2	-0.5	-0.6	-0.5	-0.4	-0.3	-0.3
Water Year Types ^c												
Wet (32%)	-0.4	-0.5	-0.2	0.4	0.7	0.4	-0.2	-0.4	-0.4	-0.3	-0.3	-0.1
Above Normal (16%)	-0.5	-0.6	-0.5	-0.1	0.3	-0.1	-0.5	-0.6	-0.6	-0.4	-0.3	-0.3
Below Normal (13%)	-0.5	-0.6	-0.6	-0.6	-0.3	-0.6	-0.7	-0.7	-0.6	-0.4	-0.3	-0.3
Dry (24%)	-0.5	-0.7	-0.8	-0.6	-0.4	-0.4	-0.7	-0.7	-0.6	-0.5	-0.4	-0.4
Critical (15%)	-0.5	-0.7	-0.7	-0.7	-0.5	-0.6	-0.7	-0.8	-0.7	-0.5	-0.4	-0.4

Alternative 5												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.3	-0.4	0.2	0.8	1.3	0.7	0.1	-0.2	-0.4	-0.2	-0.2	-0.1
20%	-0.4	-0.5	-0.2	0.3	0.5	0.1	-0.2	-0.4	-0.5	-0.3	-0.3	-0.1
30%	-0.4	-0.5	-0.5	-0.2	0.3	-0.1	-0.4	-0.5	-0.5	-0.4	-0.3	-0.2
40%	-0.5	-0.6	-0.6	-0.4	0.1	-0.3	-0.5	-0.6	-0.5	-0.4	-0.3	-0.3
50%	-0.5	-0.6	-0.6	-0.5	-0.3	-0.4	-0.6	-0.7	-0.6	-0.4	-0.4	-0.3
60%	-0.6	-0.7	-0.7	-0.6	-0.4	-0.4	-0.7	-0.7	-0.6	-0.5	-0.4	-0.3
70%	-0.6	-0.7	-0.7	-0.6	-0.5	-0.5	-0.7	-0.7	-0.6	-0.5	-0.4	-0.3
80%	-0.6	-0.8	-0.8	-0.7	-0.6	-0.7	-0.8	-0.8	-0.7	-0.5	-0.4	-0.4
90%	-0.7	-0.8	-0.9	-0.8	-0.7	-0.7	-0.8	-0.8	-0.7	-0.6	-0.5	-0.4
Long Term												
Full Simulation Period ^b	-0.5	-0.6	-0.5	-0.2	0.0	-0.2	-0.5	-0.6	-0.5	-0.4	-0.3	-0.3
Water Year Types ^c												
Wet (32%)	-0.4	-0.5	-0.2	0.4	0.7	0.4	-0.2	-0.4	-0.4	-0.3	-0.3	-0.1
Above Normal (16%)	-0.5	-0.6	-0.5	-0.1	0.3	-0.1	-0.5	-0.6	-0.6	-0.4	-0.3	-0.3
Below Normal (13%)	-0.5	-0.6	-0.6	-0.6	-0.3	-0.6	-0.7	-0.7	-0.6	-0.4	-0.3	-0.3
Dry (24%)	-0.5	-0.7	-0.8	-0.6	-0.4	-0.4	-0.7	-0.7	-0.6	-0.5	-0.4	-0.4
Critical (15%)	-0.5	-0.7	-0.7	-0.7	-0.5	-0.6	-0.7	-0.8	-0.7	-0.5	-0.4	-0.4

Alternative 5 minus No Action Alternative												
Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
30%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-45-2-4. Sacramento River at Rio Vista, Monthly Averaged Daily Minimum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.3	-0.4	0.3	0.8	1.4	0.7	0.0	-0.2	-0.4	-0.3	-0.2	-0.1
20%	-0.4	-0.5	-0.2	0.3	0.5	0.1	-0.2	-0.4	-0.4	-0.3	-0.3	-0.2
30%	-0.5	-0.6	-0.5	-0.2	0.3	0.0	-0.4	-0.5	-0.5	-0.4	-0.3	-0.3
40%	-0.5	-0.6	-0.6	-0.4	0.1	-0.3	-0.6	-0.6	-0.5	-0.4	-0.3	-0.3
50%	-0.5	-0.7	-0.7	-0.5	-0.3	-0.4	-0.6	-0.7	-0.6	-0.4	-0.4	-0.3
60%	-0.6	-0.7	-0.7	-0.6	-0.4	-0.4	-0.7	-0.7	-0.6	-0.5	-0.4	-0.3
70%	-0.6	-0.8	-0.7	-0.7	-0.5	-0.5	-0.8	-0.7	-0.6	-0.5	-0.4	-0.4
80%	-0.6	-0.8	-0.8	-0.7	-0.6	-0.7	-0.8	-0.8	-0.7	-0.5	-0.4	-0.4
90%	-0.7	-0.9	-0.9	-0.8	-0.7	-0.7	-0.9	-0.8	-0.7	-0.6	-0.5	-0.5
Long Term												
Full Simulation Period ^b	-0.5	-0.6	-0.5	-0.2	0.1	-0.2	-0.5	-0.6	-0.5	-0.4	-0.4	-0.3
Water Year Types ^c												
Wet (32%)	-0.4	-0.5	-0.1	0.4	0.7	0.4	-0.2	-0.4	-0.4	-0.3	-0.3	-0.2
Above Normal (16%)	-0.5	-0.6	-0.5	-0.1	0.3	0.0	-0.5	-0.6	-0.6	-0.4	-0.3	-0.3
Below Normal (13%)	-0.5	-0.6	-0.6	-0.6	-0.3	-0.6	-0.7	-0.7	-0.6	-0.4	-0.3	-0.3
Dry (24%)	-0.5	-0.7	-0.8	-0.7	-0.4	-0.4	-0.7	-0.7	-0.6	-0.5	-0.4	-0.4
Critical (15%)	-0.5	-0.7	-0.7	-0.7	-0.5	-0.6	-0.7	-0.8	-0.8	-0.5	-0.4	-0.4

No Action Alternative

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.3	-0.4	0.2	0.8	1.3	0.7	0.1	-0.2	-0.4	-0.2	-0.2	-0.1
20%	-0.4	-0.5	-0.2	0.3	0.5	0.1	-0.2	-0.4	-0.5	-0.3	-0.3	-0.1
30%	-0.4	-0.5	-0.5	-0.2	0.3	-0.1	-0.4	-0.5	-0.5	-0.4	-0.3	-0.2
40%	-0.5	-0.6	-0.6	-0.4	0.1	-0.3	-0.5	-0.6	-0.5	-0.4	-0.3	-0.3
50%	-0.5	-0.6	-0.6	-0.5	-0.3	-0.4	-0.6	-0.7	-0.6	-0.4	-0.4	-0.3
60%	-0.6	-0.7	-0.7	-0.6	-0.4	-0.4	-0.7	-0.7	-0.6	-0.5	-0.4	-0.3
70%	-0.6	-0.7	-0.7	-0.6	-0.5	-0.5	-0.7	-0.7	-0.6	-0.5	-0.4	-0.3
80%	-0.6	-0.8	-0.8	-0.7	-0.6	-0.7	-0.8	-0.8	-0.7	-0.5	-0.4	-0.4
90%	-0.7	-0.8	-0.9	-0.8	-0.7	-0.7	-0.8	-0.8	-0.7	-0.6	-0.5	-0.4
Long Term												
Full Simulation Period ^b	-0.5	-0.6	-0.5	-0.2	0.0	-0.2	-0.5	-0.6	-0.5	-0.4	-0.3	-0.3
Water Year Types ^c												
Wet (32%)	-0.4	-0.5	-0.2	0.4	0.7	0.4	-0.2	-0.4	-0.4	-0.3	-0.3	-0.1
Above Normal (16%)	-0.5	-0.6	-0.5	-0.1	0.3	-0.1	-0.5	-0.6	-0.6	-0.4	-0.3	-0.3
Below Normal (13%)	-0.5	-0.6	-0.6	-0.6	-0.3	-0.6	-0.7	-0.7	-0.6	-0.4	-0.3	-0.3
Dry (24%)	-0.5	-0.7	-0.8	-0.6	-0.4	-0.4	-0.7	-0.7	-0.6	-0.5	-0.4	-0.4
Critical (15%)	-0.5	-0.7	-0.7	-0.7	-0.5	-0.6	-0.7	-0.8	-0.7	-0.5	-0.4	-0.4

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.0	-0.1	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
30%	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-45-2.5. Sacramento River at Rio Vista, Monthly Averaged Daily Minimum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.3	-0.4	0.3	0.8	1.4	0.7	0.0	-0.2	-0.4	-0.3	-0.2	-0.1
20%	-0.4	-0.5	-0.2	0.3	0.5	0.1	-0.2	-0.4	-0.4	-0.3	-0.3	-0.2
30%	-0.5	-0.6	-0.5	-0.2	0.3	0.0	-0.4	-0.5	-0.5	-0.4	-0.3	-0.3
40%	-0.5	-0.6	-0.6	-0.4	0.1	-0.3	-0.6	-0.6	-0.5	-0.4	-0.3	-0.3
50%	-0.5	-0.7	-0.7	-0.5	-0.3	-0.4	-0.6	-0.7	-0.6	-0.4	-0.4	-0.3
60%	-0.6	-0.7	-0.7	-0.6	-0.4	-0.4	-0.7	-0.7	-0.6	-0.5	-0.4	-0.3
70%	-0.6	-0.8	-0.7	-0.7	-0.5	-0.5	-0.8	-0.7	-0.6	-0.5	-0.4	-0.4
80%	-0.6	-0.8	-0.8	-0.7	-0.6	-0.7	-0.8	-0.8	-0.7	-0.5	-0.4	-0.4
90%	-0.7	-0.9	-0.9	-0.8	-0.7	-0.7	-0.9	-0.8	-0.7	-0.6	-0.5	-0.5
Long Term												
Full Simulation Period ^b	-0.5	-0.6	-0.5	-0.2	0.1	-0.2	-0.5	-0.6	-0.5	-0.4	-0.4	-0.3
Water Year Types ^c												
Wet (32%)	-0.4	-0.5	-0.1	0.4	0.7	0.4	-0.2	-0.4	-0.4	-0.3	-0.3	-0.2
Above Normal (16%)	-0.5	-0.6	-0.5	-0.1	0.3	0.0	-0.5	-0.6	-0.6	-0.4	-0.3	-0.3
Below Normal (13%)	-0.5	-0.6	-0.6	-0.6	-0.3	-0.6	-0.7	-0.7	-0.6	-0.4	-0.3	-0.3
Dry (24%)	-0.5	-0.7	-0.8	-0.7	-0.4	-0.4	-0.7	-0.7	-0.6	-0.5	-0.4	-0.4
Critical (15%)	-0.5	-0.7	-0.7	-0.7	-0.5	-0.6	-0.7	-0.8	-0.8	-0.5	-0.4	-0.4

Alternative 3

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.3	-0.4	0.3	0.8	1.4	0.7	0.0	-0.2	-0.4	-0.2	-0.2	-0.1
20%	-0.4	-0.5	-0.2	0.4	0.5	0.1	-0.2	-0.4	-0.5	-0.3	-0.3	-0.2
30%	-0.5	-0.6	-0.5	-0.2	0.3	-0.1	-0.4	-0.5	-0.5	-0.4	-0.3	-0.3
40%	-0.5	-0.6	-0.6	-0.4	0.1	-0.3	-0.6	-0.6	-0.5	-0.4	-0.3	-0.3
50%	-0.5	-0.7	-0.6	-0.5	-0.3	-0.4	-0.6	-0.7	-0.6	-0.4	-0.4	-0.3
60%	-0.6	-0.7	-0.7	-0.6	-0.4	-0.4	-0.7	-0.7	-0.6	-0.5	-0.4	-0.3
70%	-0.6	-0.8	-0.7	-0.6	-0.5	-0.5	-0.8	-0.7	-0.6	-0.5	-0.4	-0.4
80%	-0.6	-0.8	-0.8	-0.7	-0.6	-0.7	-0.8	-0.8	-0.7	-0.5	-0.4	-0.4
90%	-0.7	-0.9	-0.9	-0.8	-0.7	-0.7	-0.9	-0.8	-0.7	-0.6	-0.5	-0.4
Long Term												
Full Simulation Period ^b	-0.5	-0.6	-0.5	-0.2	0.1	-0.2	-0.5	-0.6	-0.5	-0.4	-0.4	-0.3
Water Year Types ^c												
Wet (32%)	-0.4	-0.5	-0.1	0.4	0.7	0.4	-0.2	-0.4	-0.4	-0.3	-0.3	-0.2
Above Normal (16%)	-0.5	-0.6	-0.5	-0.1	0.3	0.0	-0.5	-0.6	-0.6	-0.4	-0.3	-0.3
Below Normal (13%)	-0.5	-0.7	-0.6	-0.6	-0.2	-0.6	-0.7	-0.7	-0.6	-0.4	-0.3	-0.3
Dry (24%)	-0.5	-0.7	-0.8	-0.6	-0.4	-0.4	-0.7	-0.7	-0.6	-0.5	-0.4	-0.4
Critical (15%)	-0.5	-0.7	-0.7	-0.7	-0.5	-0.6	-0.7	-0.8	-0.7	-0.5	-0.4	-0.4

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
30%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table C-45-2.6. Sacramento River at Rio Vista, Monthly Averaged Daily Minimum Elevation

Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.3	-0.4	0.3	0.8	1.4	0.7	0.0	-0.2	-0.4	-0.3	-0.2	-0.1
20%	-0.4	-0.5	-0.2	0.3	0.5	0.1	-0.2	-0.4	-0.4	-0.3	-0.3	-0.2
30%	-0.5	-0.6	-0.5	-0.2	0.3	0.0	-0.4	-0.5	-0.5	-0.4	-0.3	-0.3
40%	-0.5	-0.6	-0.6	-0.4	0.1	-0.3	-0.6	-0.6	-0.5	-0.4	-0.3	-0.3
50%	-0.5	-0.7	-0.7	-0.5	-0.3	-0.4	-0.6	-0.7	-0.6	-0.4	-0.4	-0.3
60%	-0.6	-0.7	-0.7	-0.6	-0.4	-0.4	-0.7	-0.7	-0.6	-0.5	-0.4	-0.3
70%	-0.6	-0.8	-0.7	-0.7	-0.5	-0.5	-0.8	-0.7	-0.6	-0.5	-0.4	-0.4
80%	-0.6	-0.8	-0.8	-0.7	-0.6	-0.7	-0.8	-0.8	-0.7	-0.5	-0.4	-0.4
90%	-0.7	-0.9	-0.9	-0.8	-0.7	-0.7	-0.9	-0.8	-0.7	-0.6	-0.5	-0.5
Long Term												
Full Simulation Period ^b	-0.5	-0.6	-0.5	-0.2	0.1	-0.2	-0.5	-0.6	-0.5	-0.4	-0.4	-0.3
Water Year Types ^c												
Wet (32%)	-0.4	-0.5	-0.1	0.4	0.7	0.4	-0.2	-0.4	-0.4	-0.3	-0.3	-0.2
Above Normal (16%)	-0.5	-0.6	-0.5	-0.1	0.3	0.0	-0.5	-0.6	-0.6	-0.4	-0.3	-0.3
Below Normal (13%)	-0.5	-0.6	-0.6	-0.6	-0.3	-0.6	-0.7	-0.7	-0.6	-0.4	-0.3	-0.3
Dry (24%)	-0.5	-0.7	-0.8	-0.7	-0.4	-0.4	-0.7	-0.7	-0.6	-0.5	-0.4	-0.4
Critical (15%)	-0.5	-0.7	-0.7	-0.7	-0.5	-0.6	-0.7	-0.8	-0.8	-0.5	-0.4	-0.4

Alternative 5

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.3	-0.4	0.2	0.8	1.3	0.7	0.1	-0.2	-0.4	-0.2	-0.2	-0.1
20%	-0.4	-0.5	-0.2	0.3	0.5	0.1	-0.2	-0.4	-0.5	-0.3	-0.3	-0.1
30%	-0.4	-0.5	-0.5	-0.2	0.3	-0.1	-0.4	-0.5	-0.5	-0.4	-0.3	-0.2
40%	-0.5	-0.6	-0.6	-0.4	0.1	-0.3	-0.5	-0.6	-0.5	-0.4	-0.3	-0.3
50%	-0.5	-0.6	-0.6	-0.5	-0.3	-0.4	-0.6	-0.7	-0.6	-0.4	-0.4	-0.3
60%	-0.6	-0.7	-0.7	-0.6	-0.4	-0.4	-0.7	-0.7	-0.6	-0.5	-0.4	-0.3
70%	-0.6	-0.7	-0.7	-0.6	-0.5	-0.5	-0.7	-0.7	-0.6	-0.5	-0.4	-0.3
80%	-0.6	-0.8	-0.8	-0.7	-0.6	-0.7	-0.8	-0.8	-0.7	-0.5	-0.4	-0.4
90%	-0.7	-0.8	-0.9	-0.8	-0.7	-0.7	-0.8	-0.8	-0.7	-0.6	-0.5	-0.4
Long Term												
Full Simulation Period ^b	-0.5	-0.6	-0.5	-0.2	0.0	-0.2	-0.5	-0.6	-0.5	-0.4	-0.3	-0.3
Water Year Types ^c												
Wet (32%)	-0.4	-0.5	-0.2	0.4	0.7	0.4	-0.2	-0.4	-0.4	-0.3	-0.3	-0.1
Above Normal (16%)	-0.5	-0.6	-0.5	-0.1	0.3	-0.1	-0.5	-0.6	-0.6	-0.4	-0.3	-0.3
Below Normal (13%)	-0.5	-0.6	-0.6	-0.6	-0.3	-0.6	-0.7	-0.7	-0.6	-0.4	-0.3	-0.3
Dry (24%)	-0.5	-0.7	-0.8	-0.6	-0.4	-0.4	-0.7	-0.7	-0.6	-0.5	-0.4	-0.4
Critical (15%)	-0.5	-0.7	-0.7	-0.7	-0.5	-0.6	-0.7	-0.8	-0.7	-0.5	-0.4	-0.4

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Averaged Daily Minimum Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.0	0.0	-0.1	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
30%	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
40%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
60%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

This page left blank intentionally.

1 **Appendix 5B**

2 **Sensitivity Analysis on Representation**
3 **of EID's Warren Act and EDCWA's**
4 **Water Service Contracts with**
5 **Reclamation in Alternatives 3 and 5**

6 During internal review of the CalSim II models, it was discovered that the
7 demands for the El Dorado Irrigation District (EID) and El Dorado County Water
8 Agency (EDCWA) contracts were not included in Alternatives 3 and 5, as
9 intended. In an effort to address this oversight, this appendix provides
10 information on and findings from a sensitivity analysis of potential effects of
11 including EID's Warren Act contract and EDCWA's water service contract with
12 Reclamation. The sensitivity analysis includes system operations (CalSim II) and
13 temperature (HEC-5Q) model runs with inclusion of these demands at Folsom
14 Lake. It is apparent from this analysis that inclusion of these contracts would not
15 change the previous conclusions in Chapters 5 through 21.

16 The following summary focuses on the differences seen within Folsom Lake and
17 the American River. As will be discussed further in this appendix, addition of
18 these demands did not show sensitivity to the rest of the CVP and SWP system
19 and no further model simulations were necessary to capture potential effects.

20 **5B.1 Background**

21 This section provides brief background on EID and EDCWA's Warren Act
22 contracts with Reclamation.

23 *EID Power to Consumptive Use Transfer and Warren Act Contract*

24 EID has requested to execute a Warren Act contract with Reclamation for use of
25 Folsom Reservoir to convey 17,000 acre-feet annually of non-Central Valley
26 Project (CVP) water from EID's El Dorado Hydroelectric Project (FERC
27 Project 184); a 20 megawatt power project with four small storage reservoirs
28 providing flows to the South Fork of the American River. The Contract was
29 originally negotiated and completed in 2005, but was not executed because of
30 potential operational impacts and difficulties in securing concurrence from the
31 National Marine Fisheries Service (NMFS) that this action is "not likely to
32 adversely affect" threatened and endangered species. In 2014, the Section 7
33 consultation for the EID Warren Act contract was completed with NMFS. The
34 Section 7 consultation allowed EID to transfer up to 7,500 AF without a
35 temperature control device (to target warmer diversions) and could transfer the
36 full volume of 17,000 AF after construction and implementation of a temperature
37 control device.

1 Execution of the contract will result in the diversion of flow out of Folsom
2 Reservoir. Due to the anticipated effect of this reduction in historical inflow, the
3 depletion of Folsom inflow was accounted for in the 2008 Biological Assessment
4 future conditions modeling, but not referenced in the proposed action.

5 *El Dorado County Water Agency Water Service Contract*
6 Public Law 101-514, Section 206(b) (1) (B) directed the Secretary to enter into a
7 M&I water supply contract with EDCWA for up to 15,000 AF of CVP water
8 diverted from Folsom Reservoir.

9 **5B.2 Methodology**

10 CalSim II model simulations of Alternatives 3 and 5 were rerun with inclusion of
11 these Warren Act contracts (specifically CalSim II parameters: dem_dsa70_pmi,
12 np_dr70_imi, prj_dr70_imi, DEM_D8F_WR_ANN, DEM_D8I_PMI_ANN,
13 EIDorIDPL table values) as diversions from Folsom Lake. Subsequently,
14 HEC-5Q temperature model was rerun for the American River. The results of
15 Alternatives 3 and 5 are compared with and without representation of the Warren
16 Act and water service contracts. The comparisons represent the changes solely
17 due to inclusion of these diversions at the Folsom Lake.

18 **5B.3 Results**

19 This section presents select CalSim II model results and American River
20 temperature model results.

21 Results for Shasta, Trinity and Oroville show that changes in reservoir storage
22 were less than 2% by month and when averaged by water year types. This minor
23 change was considered minor and not substantial to the system outside of the
24 American River basin. These results were consistent for both Alternative 3 and
25 Alternative 5.

26 Folsom Storage showed a less than 3% difference when averaged by water year
27 types, but larger differences between 3-6% were seen in month to month
28 comparisons. Although this is slightly higher than the differences seen elsewhere
29 in the system, the new values do not change any of the conclusions presented in
30 Chapters 5 through 21. Results at Folsom were similar for both Alternative 3 and
31 Alternative 5.

32 American River flows showed the most difference with reductions in the drier
33 water years. Alternative 3 shows more differences than Alternative 5 with
34 differences as high as 6% in August of critical years. Although these results show
35 some differences with inclusion of the contracts, these new values do not change
36 any of the conclusions presented in Chapters 5 through 21.

- 1 American River temperatures below Nimbus Dam and at Watt Avenue for
2 Alternative 5 showed a slight decrease in October of the drier years, but was
3 within 5% when averaged by water year type. Although these results show some
4 improvement in temperature with inclusion of the contracts, these new values do
5 not change any of the conclusions presented in Chapters 5 through 21.
- 6 Alternative 3 did not show any differences above 1% with the inclusion of these
7 contracts.
- 8 Temperature threshold exceedances in the American River show 1 to 2%
9 differences in Alternatives 3 and 5 with and without inclusion of the EID and
10 ECWA diversions; which is considered similar in this EIS.
- 11 These results confirm that inclusion of EID's Warren Act contract and ECWA's
12 water service contract that result in increased diversions from Folsom Lake do not
13 cause many changes greater than 5% in model results and hence do not change
14 any of the conclusions presented in Chapters 5 through 21.
- 15 The following results for Alternatives 3 and 5 are presented:
- 16 5B.3.1 Trinity Storage
 - 17 5B.3.2. Shasta Storage
 - 18 5B.3.3. Oroville Storage
 - 19 5B.3.4. Folsom Storage
 - 20 5B.3.5. Folsom Elevation
 - 21 5B.3.6. American River below Nimbus Flow
 - 22 5B.3.7. Sacramento River at Freeport Flow
 - 23 5B.3.8. Delta Outflow
 - 24 5B.3.9. Jones and Banks Export Volume
 - 25 5B.3.10. American River below Nimbus Temperature
 - 26 5B.3.11. American River at Watt Temperature
 - 27 5B.3.12. American River at Mouth Temperature
 - 28 5B.3.13 Temperature Threshold Exceedances – American River

This page left blank intentionally.

1 **5B.3.1. Trinity Storage**

Table 5B.3.1.1. Trinity Lake, End of Month Storage

Alternative 3

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,850	1,850	1,850	1,900	2,000	2,100	2,298	2,351	2,298	2,211	2,100	1,975
20%	1,815	1,831	1,849	1,900	2,000	2,100	2,259	2,246	2,204	2,064	1,903	1,818
30%	1,583	1,614	1,719	1,803	1,968	2,069	2,222	2,159	2,064	1,925	1,794	1,649
40%	1,365	1,400	1,572	1,671	1,858	1,995	2,104	2,046	1,937	1,759	1,581	1,419
50%	1,257	1,259	1,420	1,588	1,700	1,823	1,990	1,895	1,784	1,599	1,418	1,307
60%	1,169	1,205	1,233	1,318	1,536	1,721	1,787	1,748	1,674	1,495	1,334	1,221
70%	1,100	1,095	1,187	1,200	1,344	1,472	1,629	1,579	1,525	1,385	1,223	1,100
80%	909	956	961	1,041	1,155	1,250	1,429	1,407	1,322	1,160	1,019	937
90%	628	630	623	681	790	921	1,065	1,023	965	843	690	628
Long Term												
Full Simulation Period ^b	1,266	1,283	1,347	1,427	1,550	1,674	1,816	1,793	1,724	1,580	1,432	1,318
Water Year Types^c												
Wet (32%)	1,502	1,537	1,643	1,766	1,928	2,053	2,224	2,248	2,192	2,067	1,936	1,805
Above Normal (16%)	1,197	1,230	1,349	1,511	1,707	1,891	2,071	2,045	1,949	1,806	1,646	1,513
Below Normal (13%)	1,434	1,457	1,477	1,542	1,629	1,717	1,858	1,786	1,680	1,509	1,334	1,199
Dry (24%)	1,173	1,179	1,206	1,226	1,318	1,450	1,585	1,537	1,468	1,301	1,152	1,056
Critical (15%)	829	803	817	829	871	952	1,003	968	936	813	664	600

Alternative 3_WA

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,850	1,850	1,850	1,900	2,000	2,100	2,300	2,353	2,298	2,210	2,100	1,975
20%	1,815	1,832	1,849	1,900	2,000	2,100	2,259	2,246	2,209	2,070	1,905	1,819
30%	1,583	1,614	1,719	1,805	1,964	2,074	2,222	2,159	2,064	1,925	1,794	1,649
40%	1,352	1,402	1,572	1,676	1,849	1,997	2,104	2,053	1,950	1,751	1,577	1,407
50%	1,265	1,285	1,424	1,590	1,707	1,827	2,002	1,901	1,789	1,604	1,420	1,319
60%	1,170	1,208	1,247	1,335	1,545	1,721	1,789	1,750	1,675	1,497	1,340	1,222
70%	1,101	1,084	1,189	1,202	1,354	1,473	1,629	1,588	1,532	1,387	1,222	1,097
80%	916	961	972	1,053	1,157	1,252	1,433	1,416	1,325	1,160	1,030	948
90%	629	630	624	683	796	921	1,066	1,024	967	844	690	629
Long Term												
Full Simulation Period ^b	1,268	1,286	1,349	1,429	1,552	1,677	1,818	1,795	1,727	1,583	1,436	1,321
Water Year Types^c												
Wet (32%)	1,501	1,536	1,642	1,766	1,929	2,054	2,224	2,249	2,194	2,069	1,939	1,806
Above Normal (16%)	1,201	1,234	1,352	1,514	1,710	1,894	2,075	2,049	1,954	1,805	1,651	1,520
Below Normal (13%)	1,436	1,459	1,478	1,543	1,631	1,719	1,860	1,788	1,681	1,510	1,337	1,202
Dry (24%)	1,177	1,183	1,209	1,230	1,322	1,454	1,588	1,540	1,472	1,305	1,157	1,059
Critical (15%)	833	811	823	834	876	957	1,006	970	938	815	668	600

Alternative 3_WA minus Alternative 3

Statistic	End of Month Storage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	-1%	0%	0%	0%	0%	0%	0%	0%	1%	0%	0%	-1%
50%	1%	2%	0%	0%	0%	0%	1%	0%	0%	0%	0%	1%
60%	0%	0%	1%	1%	1%	0%	0%	0%	0%	0%	0%	0%
70%	0%	-1%	0%	0%	1%	0%	0%	1%	0%	0%	0%	0%
80%	1%	0%	1%	1%	0%	0%	0%	1%	0%	0%	1%	1%
90%	0%	0%	0%	0%	1%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	1%	1%	1%	1%	1%	1%	0%	0%	0%	0%	1%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Note: All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.

Table 5B.3.1.2. Trinity Lake, End of Month Storage

Alternative 5

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,850	1,828	1,850	1,900	2,000	2,100	2,283	2,344	2,306	2,262	2,143	1,932
20%	1,764	1,735	1,803	1,889	2,000	2,100	2,250	2,276	2,207	2,064	1,893	1,743
30%	1,542	1,577	1,694	1,779	1,954	2,084	2,220	2,159	2,055	1,913	1,776	1,631
40%	1,427	1,373	1,560	1,683	1,770	1,994	2,131	2,029	1,921	1,779	1,600	1,453
50%	1,231	1,253	1,376	1,518	1,671	1,771	1,895	1,842	1,728	1,563	1,420	1,309
60%	1,127	1,172	1,247	1,279	1,493	1,669	1,798	1,720	1,634	1,479	1,271	1,148
70%	1,051	1,037	1,098	1,146	1,250	1,378	1,484	1,460	1,390	1,268	1,139	1,067
80%	834	850	879	977	1,036	1,141	1,321	1,259	1,209	1,066	941	830
90%	537	589	594	628	733	908	983	967	922	811	607	553
Long Term												
Full Simulation Period ^b	1,235	1,244	1,309	1,387	1,512	1,638	1,779	1,756	1,688	1,553	1,411	1,288
Water Year Types^c												
Wet (32%)	1,494	1,520	1,635	1,759	1,926	2,056	2,222	2,246	2,191	2,068	1,940	1,781
Above Normal (16%)	1,155	1,180	1,290	1,459	1,662	1,850	2,030	2,004	1,912	1,778	1,627	1,503
Below Normal (13%)	1,398	1,405	1,422	1,493	1,580	1,667	1,813	1,741	1,637	1,474	1,311	1,190
Dry (24%)	1,155	1,150	1,175	1,183	1,275	1,404	1,540	1,492	1,415	1,259	1,110	1,012
Critical (15%)	744	726	741	743	784	866	913	878	856	755	622	539

Alternative 5_WA

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,850	1,828	1,850	1,900	2,000	2,100	2,283	2,344	2,306	2,262	2,144	1,932
20%	1,764	1,735	1,799	1,889	2,000	2,100	2,251	2,271	2,202	2,064	1,893	1,744
30%	1,546	1,594	1,681	1,779	1,961	2,085	2,217	2,159	2,061	1,913	1,776	1,631
40%	1,427	1,381	1,558	1,680	1,767	1,988	2,136	2,029	1,925	1,778	1,612	1,455
50%	1,233	1,254	1,379	1,534	1,672	1,769	1,903	1,839	1,723	1,568	1,417	1,314
60%	1,138	1,167	1,246	1,268	1,491	1,667	1,790	1,730	1,637	1,440	1,256	1,149
70%	1,046	1,036	1,102	1,151	1,276	1,390	1,495	1,479	1,395	1,284	1,153	1,075
80%	818	847	882	977	1,050	1,142	1,327	1,271	1,205	1,056	938	840
90%	534	589	618	624	732	908	998	967	922	812	617	549
Long Term												
Full Simulation Period ^b	1,236	1,245	1,310	1,387	1,513	1,639	1,781	1,757	1,689	1,553	1,411	1,290
Water Year Types^c												
Wet (32%)	1,492	1,517	1,633	1,758	1,924	2,055	2,221	2,245	2,190	2,067	1,940	1,783
Above Normal (16%)	1,156	1,182	1,291	1,460	1,663	1,851	2,031	2,005	1,913	1,780	1,629	1,505
Below Normal (13%)	1,400	1,408	1,425	1,495	1,582	1,669	1,820	1,748	1,644	1,481	1,318	1,199
Dry (24%)	1,159	1,153	1,179	1,186	1,278	1,407	1,543	1,494	1,418	1,255	1,106	1,011
Critical (15%)	745	726	742	744	787	868	915	880	854	754	623	536

Alternative 5_WA minus Alternative 5

Statistic	End of Month Storage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	1%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	1%	0%
50%	0%	0%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%
60%	1%	0%	0%	-1%	0%	0%	0%	1%	0%	-3%	-1%	0%
70%	0%	0%	0%	0%	2%	1%	1%	1%	0%	1%	1%	1%
80%	-2%	0%	0%	0%	1%	0%	0%	1%	0%	-1%	0%	1%
90%	-1%	0%	4%	-1%	0%	0%	2%	0%	0%	0%	2%	-1%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	1%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Note: All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.

1 **5B.3.2. Shasta Storage**

Table 5B.3.2.1. Shasta Lake, End of Month Storage

Alternative 3

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,250	3,252	3,349	3,639	3,910	4,225	4,481	4,552	4,434	3,884	3,579	3,400
20%	3,200	3,251	3,321	3,552	3,771	4,127	4,435	4,552	4,276	3,764	3,421	3,358
30%	3,094	3,161	3,292	3,513	3,675	4,020	4,382	4,515	4,155	3,528	3,171	3,106
40%	2,918	3,066	3,257	3,370	3,592	3,975	4,281	4,367	3,917	3,296	2,999	2,933
50%	2,680	2,774	3,085	3,277	3,484	3,866	4,177	4,228	3,736	3,148	2,761	2,735
60%	2,475	2,593	2,921	3,173	3,330	3,751	4,078	3,987	3,504	2,992	2,668	2,579
70%	2,379	2,412	2,634	2,889	3,252	3,513	3,895	3,731	3,375	2,802	2,547	2,448
80%	2,107	2,114	2,239	2,610	2,981	3,387	3,636	3,552	2,996	2,475	2,188	2,146
90%	1,527	1,514	1,581	2,107	2,371	2,814	2,706	2,899	2,628	2,089	1,752	1,621
Long Term												
Full Simulation Period ^b	2,525	2,578	2,750	3,019	3,284	3,636	3,914	3,908	3,543	3,013	2,687	2,605
Water Year Types^c												
Wet (32%)	2,816	2,932	3,161	3,408	3,597	3,841	4,301	4,453	4,221	3,720	3,370	3,244
Above Normal (16%)	2,475	2,555	2,783	3,303	3,509	4,023	4,403	4,401	3,975	3,350	2,998	2,946
Below Normal (13%)	2,818	2,851	2,983	3,302	3,650	3,971	4,176	4,056	3,631	3,036	2,669	2,562
Dry (24%)	2,431	2,451	2,590	2,770	3,189	3,662	3,885	3,798	3,359	2,826	2,542	2,500
Critical (15%)	1,833	1,793	1,877	2,024	2,184	2,424	2,354	2,237	1,836	1,406	1,129	1,066

Alternative 3_WA

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,250	3,252	3,349	3,639	3,911	4,225	4,480	4,552	4,434	3,886	3,577	3,400
20%	3,196	3,250	3,321	3,552	3,771	4,125	4,435	4,552	4,275	3,764	3,416	3,347
30%	3,091	3,171	3,298	3,514	3,675	4,020	4,384	4,509	4,154	3,528	3,167	3,136
40%	2,919	3,055	3,252	3,370	3,596	3,975	4,280	4,363	3,915	3,295	2,999	2,934
50%	2,680	2,772	3,099	3,270	3,477	3,865	4,175	4,227	3,732	3,155	2,759	2,732
60%	2,469	2,598	2,921	3,189	3,329	3,746	4,076	3,986	3,502	3,001	2,673	2,599
70%	2,380	2,401	2,629	2,891	3,252	3,513	3,890	3,732	3,370	2,796	2,548	2,466
80%	2,109	2,117	2,249	2,597	2,987	3,377	3,638	3,559	2,989	2,461	2,176	2,140
90%	1,515	1,502	1,569	2,110	2,372	2,815	2,708	2,913	2,639	2,096	1,749	1,608
Long Term												
Full Simulation Period ^b	2,525	2,577	2,750	3,019	3,284	3,636	3,914	3,908	3,543	3,013	2,686	2,606
Water Year Types^c												
Wet (32%)	2,818	2,934	3,161	3,409	3,597	3,841	4,301	4,454	4,220	3,718	3,367	3,246
Above Normal (16%)	2,471	2,549	2,782	3,302	3,508	4,024	4,404	4,401	3,972	3,353	2,996	2,948
Below Normal (13%)	2,817	2,849	2,981	3,301	3,648	3,969	4,173	4,053	3,629	3,034	2,668	2,562
Dry (24%)	2,432	2,452	2,592	2,771	3,190	3,662	3,885	3,799	3,358	2,826	2,543	2,502
Critical (15%)	1,834	1,791	1,875	2,024	2,183	2,424	2,356	2,240	1,840	1,412	1,128	1,067

Alternative 3_WA minus Alternative 3

Statistic	End of Month Storage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	1%	0%	0%	0%	0%	0%	0%	0%	1%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	-1%	0%
90%	-1%	-1%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	-1%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Note: All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.

Table 5B.3.2.2. Shasta Lake, End of Month Storage

Alternative 5

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,200	3,242	3,322	3,615	3,812	4,217	4,486	4,552	4,451	3,905	3,580	3,188
20%	3,018	2,911	3,293	3,525	3,704	4,114	4,434	4,552	4,282	3,762	3,471	3,041
30%	2,878	2,770	3,252	3,370	3,616	3,998	4,371	4,542	4,196	3,578	3,239	2,971
40%	2,735	2,684	3,037	3,270	3,496	3,944	4,260	4,435	3,973	3,313	3,027	2,866
50%	2,615	2,540	2,771	3,188	3,391	3,756	4,139	4,223	3,785	3,196	2,859	2,722
60%	2,495	2,452	2,537	2,971	3,284	3,590	3,989	3,967	3,595	3,020	2,738	2,605
70%	2,246	2,250	2,355	2,639	3,163	3,417	3,748	3,615	3,292	2,728	2,489	2,330
80%	1,912	1,958	2,146	2,447	2,766	3,151	3,485	3,251	2,855	2,356	2,051	1,979
90%	1,216	1,196	1,281	1,929	2,246	2,565	2,672	2,777	2,423	1,794	1,341	1,308
Long Term												
Full Simulation Period ^b	2,399	2,377	2,593	2,900	3,185	3,552	3,838	3,859	3,534	2,991	2,675	2,483
Water Year Types^c												
Wet (32%)	2,704	2,716	3,078	3,385	3,590	3,836	4,299	4,461	4,243	3,736	3,410	2,989
Above Normal (16%)	2,369	2,388	2,598	3,164	3,454	4,019	4,401	4,430	4,042	3,409	3,071	2,842
Below Normal (13%)	2,603	2,565	2,704	3,077	3,450	3,820	4,039	3,970	3,602	3,012	2,663	2,620
Dry (24%)	2,344	2,287	2,433	2,627	3,039	3,509	3,745	3,699	3,315	2,787	2,497	2,459
Critical (15%)	1,676	1,611	1,700	1,856	2,015	2,258	2,203	2,104	1,749	1,246	958	910

Alternative 5_WA

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,200	3,249	3,322	3,615	3,812	4,217	4,486	4,552	4,451	3,905	3,578	3,186
20%	3,004	2,911	3,293	3,525	3,700	4,114	4,434	4,552	4,282	3,762	3,471	3,039
30%	2,876	2,772	3,252	3,367	3,616	3,998	4,371	4,543	4,197	3,580	3,239	2,968
40%	2,723	2,681	3,033	3,270	3,488	3,940	4,258	4,434	3,979	3,313	3,027	2,854
50%	2,609	2,534	2,762	3,187	3,382	3,756	4,136	4,222	3,785	3,197	2,855	2,727
60%	2,499	2,453	2,532	2,958	3,284	3,590	3,992	3,971	3,591	3,037	2,739	2,607
70%	2,242	2,237	2,357	2,632	3,155	3,417	3,743	3,608	3,282	2,774	2,493	2,333
80%	1,911	1,952	2,141	2,447	2,764	3,145	3,450	3,221	2,839	2,346	2,084	1,980
90%	1,218	1,197	1,283	1,927	2,253	2,534	2,686	2,778	2,423	1,797	1,345	1,309
Long Term												
Full Simulation Period ^b	2,398	2,376	2,591	2,899	3,183	3,551	3,836	3,858	3,532	2,990	2,674	2,480
Water Year Types^c												
Wet (32%)	2,704	2,718	3,077	3,385	3,590	3,836	4,299	4,461	4,243	3,733	3,408	2,984
Above Normal (16%)	2,368	2,388	2,600	3,165	3,453	4,019	4,402	4,431	4,043	3,409	3,070	2,837
Below Normal (13%)	2,597	2,559	2,698	3,072	3,445	3,816	4,029	3,962	3,593	3,005	2,656	2,611
Dry (24%)	2,343	2,284	2,430	2,624	3,036	3,507	3,742	3,697	3,313	2,793	2,504	2,463
Critical (15%)	1,679	1,612	1,701	1,857	2,014	2,256	2,201	2,102	1,749	1,245	954	911

Alternative 5_WA minus Alternative 5

Statistic	End of Month Storage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	0%	0%
70%	0%	-1%	0%	0%	0%	0%	0%	0%	0%	2%	0%	0%
80%	0%	0%	0%	0%	0%	0%	-1%	-1%	-1%	0%	2%	0%
90%	0%	0%	0%	0%	0%	-1%	1%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Note: All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.

1 **5B.3.3. Oroville Storage**

Table 5B.3.3.1. Lake Oroville, End of Month Storage

Alternative 3

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,639	2,548	2,788	2,807	2,943	3,052	3,352	3,538	3,538	3,046	2,791	2,727
20%	2,094	2,155	2,500	2,788	2,802	2,983	3,298	3,538	3,522	2,898	2,518	2,283
30%	1,905	1,889	2,078	2,450	2,788	2,938	3,268	3,454	3,177	2,562	2,273	2,045
40%	1,641	1,686	1,860	2,278	2,724	2,839	3,208	3,295	2,954	2,317	1,982	1,701
50%	1,264	1,293	1,647	2,109	2,565	2,788	3,081	3,061	2,744	2,106	1,708	1,470
60%	1,195	1,126	1,375	1,678	2,130	2,642	2,884	2,819	2,450	1,867	1,429	1,251
70%	1,103	1,056	1,110	1,356	1,827	2,179	2,527	2,549	2,185	1,605	1,309	1,244
80%	1,023	964	999	1,157	1,459	1,739	2,034	2,029	1,743	1,344	1,242	1,136
90%	918	905	907	1,016	1,239	1,461	1,663	1,666	1,294	1,167	1,050	974
Long Term												
Full Simulation Period ^b	1,560	1,554	1,717	1,961	2,248	2,472	2,733	2,798	2,580	2,108	1,823	1,674
Water Year Types^c												
Wet (32%)	1,893	1,931	2,315	2,608	2,854	2,942	3,300	3,473	3,375	2,902	2,630	2,499
Above Normal (16%)	1,405	1,448	1,623	2,109	2,623	2,945	3,280	3,371	3,129	2,494	2,039	1,778
Below Normal (13%)	1,839	1,801	1,846	2,054	2,370	2,636	2,879	2,883	2,610	1,971	1,520	1,354
Dry (24%)	1,332	1,288	1,322	1,454	1,733	2,088	2,329	2,319	1,980	1,548	1,343	1,198
Critical (15%)	1,129	1,067	1,067	1,156	1,275	1,429	1,449	1,437	1,236	1,029	918	862

Alternative 3_WA

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,642	2,557	2,788	2,807	2,939	3,052	3,352	3,538	3,538	3,045	2,784	2,720
20%	2,098	2,155	2,508	2,788	2,802	2,983	3,298	3,538	3,522	2,897	2,519	2,282
30%	1,910	1,890	2,118	2,452	2,788	2,940	3,268	3,454	3,174	2,559	2,268	2,051
40%	1,647	1,673	1,860	2,284	2,751	2,841	3,208	3,294	2,954	2,318	1,982	1,705
50%	1,267	1,293	1,645	2,119	2,569	2,788	3,085	3,064	2,746	2,109	1,708	1,479
60%	1,192	1,128	1,358	1,670	2,132	2,643	2,880	2,822	2,451	1,865	1,423	1,250
70%	1,103	1,052	1,108	1,354	1,833	2,194	2,526	2,548	2,183	1,602	1,307	1,244
80%	1,023	964	997	1,157	1,458	1,723	2,037	2,029	1,739	1,347	1,242	1,136
90%	909	906	907	1,013	1,239	1,454	1,661	1,664	1,284	1,137	1,018	942
Long Term												
Full Simulation Period ^b	1,560	1,553	1,718	1,961	2,248	2,471	2,732	2,797	2,579	2,106	1,822	1,674
Water Year Types^c												
Wet (32%)	1,892	1,931	2,315	2,608	2,854	2,942	3,300	3,472	3,374	2,901	2,630	2,499
Above Normal (16%)	1,406	1,448	1,631	2,115	2,627	2,945	3,280	3,371	3,130	2,494	2,039	1,775
Below Normal (13%)	1,841	1,802	1,847	2,056	2,372	2,638	2,880	2,885	2,611	1,971	1,520	1,356
Dry (24%)	1,330	1,287	1,321	1,454	1,733	2,088	2,328	2,317	1,978	1,546	1,341	1,201
Critical (15%)	1,129	1,064	1,063	1,152	1,271	1,425	1,445	1,434	1,232	1,024	913	857

Alternative 3_WA minus Alternative 3

Statistic	End of Month Storage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	2%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	-1%	0%	0%	1%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%
60%	0%	0%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	0%	1%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	-1%	0%	0%	0%	0%	0%	0%
90%	-1%	0%	0%	0%	0%	0%	0%	0%	-1%	-3%	-3%	-3%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Note: All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.

Table 5B.3.3.2. Lake Oroville, End of Month Storage

Alternative 5

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,047	2,116	2,763	2,788	2,921	3,035	3,352	3,538	3,538	3,017	2,704	2,150
20%	1,778	1,801	2,036	2,655	2,788	2,964	3,298	3,538	3,538	2,951	2,508	1,961
30%	1,614	1,653	1,810	2,267	2,788	2,898	3,268	3,475	3,367	2,759	2,317	1,829
40%	1,402	1,371	1,559	1,931	2,557	2,788	3,208	3,336	3,132	2,493	2,005	1,562
50%	1,248	1,251	1,433	1,709	2,177	2,642	2,928	3,020	2,849	2,218	1,753	1,349
60%	1,170	1,145	1,252	1,595	1,940	2,279	2,607	2,720	2,516	1,870	1,438	1,245
70%	1,101	1,050	1,095	1,309	1,693	2,044	2,225	2,340	2,049	1,478	1,243	1,176
80%	1,011	974	1,004	1,166	1,440	1,710	1,910	1,894	1,717	1,241	1,135	1,051
90%	894	895	903	1,030	1,250	1,489	1,661	1,579	1,306	1,167	1,050	954
Long Term												
Full Simulation Period ^b	1,403	1,394	1,568	1,836	2,151	2,393	2,660	2,770	2,622	2,134	1,821	1,514
Water Year Types^c												
Wet (32%)	1,681	1,723	2,179	2,556	2,833	2,942	3,300	3,488	3,447	2,961	2,613	2,103
Above Normal (16%)	1,275	1,310	1,471	1,948	2,512	2,892	3,247	3,401	3,241	2,608	2,125	1,668
Below Normal (13%)	1,552	1,507	1,517	1,728	2,132	2,406	2,663	2,746	2,569	1,959	1,521	1,305
Dry (24%)	1,223	1,173	1,190	1,319	1,595	1,952	2,193	2,255	1,992	1,502	1,295	1,150
Critical (15%)	1,102	1,037	1,025	1,114	1,229	1,383	1,415	1,411	1,266	1,045	929	873

Alternative 5_WA

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,045	2,110	2,745	2,788	2,916	3,035	3,352	3,538	3,538	3,015	2,706	2,152
20%	1,777	1,803	2,035	2,653	2,788	2,964	3,298	3,538	3,537	2,951	2,501	1,960
30%	1,615	1,652	1,804	2,266	2,788	2,898	3,268	3,475	3,367	2,756	2,321	1,832
40%	1,403	1,377	1,559	1,932	2,557	2,788	3,208	3,336	3,133	2,492	2,004	1,560
50%	1,248	1,251	1,432	1,709	2,176	2,641	2,928	3,021	2,852	2,218	1,754	1,348
60%	1,171	1,147	1,252	1,598	1,938	2,290	2,607	2,720	2,514	1,868	1,440	1,247
70%	1,102	1,051	1,094	1,309	1,693	2,048	2,226	2,339	2,043	1,488	1,242	1,175
80%	1,011	974	1,004	1,167	1,440	1,710	1,911	1,893	1,711	1,241	1,133	1,052
90%	893	895	902	1,030	1,246	1,489	1,665	1,578	1,300	1,166	1,049	953
Long Term												
Full Simulation Period ^b	1,403	1,394	1,568	1,836	2,151	2,393	2,661	2,770	2,622	2,133	1,820	1,515
Water Year Types^c												
Wet (32%)	1,682	1,724	2,180	2,556	2,833	2,942	3,300	3,488	3,445	2,958	2,611	2,104
Above Normal (16%)	1,274	1,309	1,470	1,946	2,511	2,892	3,247	3,401	3,240	2,608	2,124	1,667
Below Normal (13%)	1,554	1,510	1,519	1,731	2,135	2,409	2,666	2,748	2,572	1,961	1,520	1,304
Dry (24%)	1,222	1,173	1,190	1,319	1,595	1,951	2,193	2,255	1,991	1,500	1,295	1,150
Critical (15%)	1,100	1,036	1,025	1,113	1,228	1,382	1,414	1,411	1,263	1,044	929	873

Alternative 5_WA minus Alternative 5

Statistic	End of Month Storage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Note: All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.

1 **5B.3.4. Folsom Storage**

Table 5B.3.4.1. Folsom Lake, End of Month Storage

Alternative 3

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	688	567	567	567	567	661	792	967	967	921	792	751
20%	592	563	567	567	567	656	792	967	967	814	709	648
30%	548	537	564	564	560	652	792	967	958	726	647	605
40%	483	495	523	556	556	646	792	967	899	636	567	522
50%	396	432	502	520	545	633	792	957	793	546	465	429
60%	348	387	450	469	499	621	790	859	749	485	434	397
70%	329	358	405	431	457	603	734	758	655	431	381	366
80%	304	329	342	389	438	563	649	656	547	392	346	331
90%	259	260	251	297	384	446	484	479	428	312	285	290
Long Term												
Full Simulation Period ^b	432	424	456	474	493	591	714	822	755	580	508	473
Water Year Types^c												
Wet (32%)	486	473	525	524	515	632	785	951	929	790	690	645
Above Normal (16%)	388	404	454	537	539	640	787	946	851	580	516	479
Below Normal (13%)	513	496	505	514	542	627	764	844	766	506	436	407
Dry (24%)	405	398	420	434	482	580	692	761	654	491	436	411
Critical (15%)	331	314	322	325	370	436	474	485	431	343	291	257

Alternative 3_WA

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	679	567	567	567	567	661	792	967	967	915	792	742
20%	591	562	567	567	567	656	792	967	967	810	707	641
30%	533	534	557	563	560	652	792	967	952	722	636	599
40%	468	480	523	554	556	645	792	967	895	627	557	507
50%	382	427	499	524	545	633	792	952	791	540	468	423
60%	338	381	437	461	496	621	792	853	747	482	425	390
70%	315	349	401	432	457	598	730	760	655	434	372	354
80%	295	328	339	384	433	549	643	646	543	379	333	318
90%	257	257	238	292	377	443	489	484	422	299	277	280
Long Term												
Full Simulation Period ^b	425	418	452	471	492	590	712	819	751	575	501	465
Water Year Types^c												
Wet (32%)	481	469	524	524	515	632	784	950	927	787	686	639
Above Normal (16%)	381	398	450	537	539	640	786	944	848	573	505	466
Below Normal (13%)	506	490	503	513	542	626	762	841	764	500	427	396
Dry (24%)	395	389	411	426	477	575	688	756	649	486	430	403
Critical (15%)	325	310	319	323	368	434	471	480	425	336	286	254

Alternative 3_WA minus Alternative 3

Statistic	End of Month Storage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	0%	-1%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	0%	-1%
30%	-3%	0%	-1%	0%	0%	0%	0%	0%	-1%	-1%	-2%	-1%
40%	-3%	-3%	0%	0%	0%	0%	0%	0%	-1%	-2%	-3%	-3%
50%	-4%	-1%	-1%	1%	0%	0%	0%	-1%	0%	-1%	1%	-2%
60%	-3%	-2%	-3%	-2%	-1%	0%	0%	-1%	0%	-1%	-2%	-2%
70%	-4%	-2%	-1%	0%	0%	-1%	0%	0%	0%	1%	-3%	-3%
80%	-3%	0%	-1%	-1%	-1%	-2%	-1%	-2%	-1%	-3%	-4%	-4%
90%	-1%	-1%	-5%	-2%	-2%	-1%	1%	1%	-1%	-4%	-3%	-3%
Long Term												
Full Simulation Period ^b	-2%	-1%	-1%	-1%	0%	0%	0%	0%	0%	-1%	-1%	-2%
Water Year Types^c												
Wet (32%)	-1%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	-1%
Above Normal (16%)	-2%	-1%	-1%	0%	0%	0%	0%	0%	0%	-1%	-2%	-3%
Below Normal (13%)	-1%	-1%	0%	0%	0%	0%	0%	0%	0%	-1%	-2%	-3%
Dry (24%)	-3%	-2%	-2%	-2%	-1%	-1%	-1%	-1%	-1%	-1%	-2%	-2%
Critical (15%)	-2%	-1%	-1%	-1%	0%	0%	-1%	-1%	-1%	-2%	-2%	-1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Note: All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.

Table 5B.3.4.2. Folsom Lake, End of Month Storage

Alternative 5

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	592	533	567	567	567	661	792	967	967	869	792	665
20%	538	489	567	565	566	656	792	967	967	818	733	604
30%	503	463	537	557	558	652	792	967	967	738	664	559
40%	455	429	503	541	553	646	792	967	933	665	608	521
50%	412	409	444	479	530	633	792	965	874	595	514	449
60%	353	392	417	448	496	621	790	861	773	524	460	401
70%	329	353	400	422	450	593	736	756	682	432	386	364
80%	294	314	350	370	412	542	626	665	552	383	349	333
90%	227	249	239	299	381	432	484	498	430	331	285	248
Long Term												
Full Simulation Period ^b	407	394	439	461	490	590	715	825	766	587	520	453
Water Year Types^c												
Wet (32%)	454	435	515	518	515	632	785	952	941	794	710	577
Above Normal (16%)	375	379	428	513	532	640	787	946	888	622	554	478
Below Normal (13%)	440	425	461	483	534	620	758	845	783	523	469	450
Dry (24%)	397	386	411	426	479	579	691	766	664	489	435	410
Critical (15%)	325	304	314	320	367	433	483	499	411	324	257	231

Alternative 5_WA

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	590	530	567	567	567	661	792	967	967	888	786	664
20%	533	485	567	565	566	656	792	967	967	819	728	602
30%	501	463	535	557	558	652	792	967	966	732	654	557
40%	448	419	501	539	553	644	792	967	928	653	599	512
50%	402	404	442	479	530	633	792	960	862	586	513	438
60%	345	387	410	443	495	621	792	855	765	522	454	396
70%	322	350	398	420	451	592	732	758	672	423	376	359
80%	286	302	347	366	407	540	628	652	550	369	336	314
90%	229	242	228	296	377	425	475	488	427	337	292	248
Long Term												
Full Simulation Period ^b	401	389	436	459	488	588	712	821	762	582	513	447
Water Year Types^c												
Wet (32%)	449	432	514	518	515	632	785	950	938	791	704	573
Above Normal (16%)	372	377	427	513	531	640	786	945	884	614	544	472
Below Normal (13%)	433	419	458	481	533	619	756	842	777	515	460	439
Dry (24%)	389	380	405	421	477	576	688	762	659	485	429	403
Critical (15%)	317	299	309	314	360	427	475	489	403	319	253	228

Alternative 5_WA minus Alternative 5

Statistic	End of Month Storage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	-1%	0%	0%	0%	0%	0%	0%	0%	2%	-1%	0%
20%	-1%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	-2%	0%
40%	-1%	-2%	0%	0%	0%	0%	0%	0%	-1%	-2%	-1%	-2%
50%	-3%	-1%	0%	0%	0%	0%	0%	0%	-1%	-2%	0%	-3%
60%	-2%	-1%	-2%	-1%	0%	0%	0%	-1%	-1%	0%	-1%	-1%
70%	-2%	-1%	0%	0%	0%	0%	0%	0%	-1%	-2%	-3%	-2%
80%	-3%	-4%	-1%	-1%	-1%	0%	0%	-2%	0%	-4%	-4%	-5%
90%	1%	-3%	-5%	-1%	-1%	-2%	-2%	-2%	-1%	2%	2%	0%
Long Term												
Full Simulation Period ^b	-1%	-1%	-1%	-1%	0%	0%	0%	0%	-1%	-1%	-1%	-1%
Water Year Types^c												
Wet (32%)	-1%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	-1%
Above Normal (16%)	-1%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	-2%	-1%
Below Normal (13%)	-2%	-1%	-1%	0%	0%	0%	0%	0%	-1%	-2%	-2%	-2%
Dry (24%)	-2%	-2%	-1%	-1%	-1%	-1%	0%	-1%	-1%	-1%	-1%	-2%
Critical (15%)	-2%	-2%	-2%	-2%	-2%	-1%	-2%	-2%	-2%	-2%	-1%	-1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Note: All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.

1 **5B.3.5. Folsom Elevation**

Table 5B.3.5.1. Folsom Lake, End of Month Elevation

Alternative 3

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	439	424	424	424	424	436	449	467	467	462	449	445
20%	427	424	424	424	424	435	449	467	467	451	441	434
30%	422	421	424	424	423	435	449	467	465	443	434	429
40%	414	415	419	423	423	434	449	467	459	433	424	419
50%	403	408	416	418	422	433	449	465	449	422	412	407
60%	396	402	410	412	416	431	449	455	445	414	408	403
70%	393	397	404	407	411	429	443	446	435	407	401	399
80%	389	393	395	402	408	424	435	435	422	403	395	393
90%	380	381	379	387	402	409	414	413	407	390	385	386
Long Term												
Full Simulation Period ^b	404	404	409	412	415	427	440	451	444	423	414	409
Water Year Types^c												
Wet (32%)	413	412	419	419	418	432	448	465	463	448	438	433
Above Normal (16%)	395	397	408	421	421	433	448	465	455	425	418	413
Below Normal (13%)	416	415	416	417	421	432	446	454	446	415	404	401
Dry (24%)	401	401	405	407	414	426	438	445	434	414	407	404
Critical (15%)	388	386	390	390	396	406	411	411	403	389	379	372

Alternative 3_WA

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	438	424	424	424	424	436	449	467	467	461	449	444
20%	427	424	424	424	424	435	449	467	467	451	441	434
30%	420	420	423	424	423	435	449	467	465	442	433	428
40%	412	414	419	423	423	434	449	467	459	432	423	417
50%	401	407	416	419	422	433	449	465	449	421	412	406
60%	394	401	408	411	415	431	449	455	445	414	407	402
70%	390	396	404	408	411	428	443	446	435	408	400	397
80%	387	392	394	402	408	422	434	434	421	401	393	391
90%	380	380	376	387	401	409	415	414	406	388	384	384
Long Term												
Full Simulation Period ^b	403	403	409	411	414	427	440	451	443	422	413	408
Water Year Types^c												
Wet (32%)	412	412	419	419	418	432	448	465	463	448	437	432
Above Normal (16%)	393	396	407	421	421	433	448	464	455	425	417	412
Below Normal (13%)	415	414	416	417	421	432	446	454	446	414	403	399
Dry (24%)	400	400	404	406	413	425	438	445	433	413	406	402
Critical (15%)	387	385	389	390	396	406	410	410	402	388	378	371

Alternative 3_WA minus Alternative 3

Statistic	End of Month Elevation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	-1%
90%	0%	0%	-1%	0%	0%	0%	0%	0%	0%	-1%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Note: All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.

Table 5B.3.5.2. Folsom Lake, End of Month Elevation

Alternative 5

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	427	420	424	424	424	436	449	466	466	457	449	437
20%	421	415	424	424	424	435	449	466	466	452	443	429
30%	416	411	421	423	423	435	449	466	466	444	436	423
40%	410	407	416	421	423	434	449	466	463	437	429	419
50%	405	405	409	413	420	433	449	466	457	428	418	410
60%	397	403	406	410	415	431	449	456	447	419	411	404
70%	393	397	404	406	410	428	444	446	438	408	402	398
80%	387	390	396	399	405	421	432	437	423	401	396	393
90%	374	378	376	388	401	407	414	416	407	393	385	378
Long Term												
Full Simulation Period ^b	401	400	407	410	414	427	440	451	444	424	415	407
Water Year Types^c												
Wet (32%)	409	407	418	418	418	432	448	465	464	449	440	425
Above Normal (16%)	394	395	405	418	420	433	449	464	458	431	423	413
Below Normal (13%)	406	405	410	413	420	431	445	454	447	417	411	408
Dry (24%)	400	400	404	406	413	426	438	446	435	413	406	403
Critical (15%)	386	384	389	390	396	406	412	414	400	385	370	365

Alternative 5_WA

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	427	420	424	424	424	436	449	467	467	458	448	436
20%	420	414	424	424	424	435	449	467	467	452	443	429
30%	416	411	420	423	423	435	449	467	467	443	435	423
40%	410	406	416	421	423	434	449	467	462	435	428	417
50%	404	404	409	413	420	433	449	465	456	427	418	408
60%	395	402	405	409	415	431	449	455	446	419	410	403
70%	392	396	403	406	410	427	443	446	437	406	400	398
80%	385	388	396	399	404	421	432	435	422	399	394	390
90%	374	377	374	387	401	407	413	414	407	394	386	378
Long Term												
Full Simulation Period ^b	400	399	407	410	414	427	440	451	444	423	414	406
Water Year Types^c												
Wet (32%)	408	407	418	418	418	432	448	465	464	448	439	424
Above Normal (16%)	394	395	405	418	420	433	448	464	458	430	421	412
Below Normal (13%)	404	404	409	413	420	431	445	454	447	416	409	407
Dry (24%)	399	399	403	405	413	425	438	445	434	412	405	402
Critical (15%)	385	383	388	389	395	405	410	411	398	383	369	365

Alternative 5_WA minus Alternative 5

Statistic	End of Month Elevation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	-1%	-1%
90%	0%	0%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Note: All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.

1 **5B.3.6. American River below Nimbus Flow**

Table 5B.3.6.1. American River d/s of Nimbus Dam, Monthly Flow

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,022	3,873	9,622	12,160	14,655	9,756	6,737	7,450	4,944	5,000	3,092	1,949
20%	1,714	3,207	4,325	7,873	10,797	6,816	5,085	4,486	4,005	5,000	2,542	1,687
30%	1,500	2,069	2,733	5,563	7,391	5,044	4,484	3,543	3,661	4,999	2,018	1,533
40%	1,500	1,925	2,000	3,579	5,756	4,172	3,491	2,838	3,200	3,840	1,875	1,533
50%	1,500	1,893	2,000	1,890	3,718	3,047	2,548	2,240	2,664	3,535	1,750	1,533
60%	1,500	1,683	1,960	1,700	2,605	2,017	2,152	1,750	2,230	2,900	1,750	1,533
70%	1,425	1,448	1,596	1,700	1,445	1,747	1,747	1,616	1,851	2,579	1,648	1,493
80%	1,150	1,150	1,244	1,374	1,264	1,059	1,073	1,112	1,598	2,013	1,081	800
90%	800	800	800	825	982	800	800	804	1,011	1,250	800	800
Long Term												
Full Simulation Period ^b	1,496	2,397	3,855	5,095	6,027	4,288	3,390	3,100	2,999	3,396	1,849	1,449
Water Year Types^c												
Wet (32%)	1,696	3,301	7,254	10,565	10,615	7,210	5,522	5,541	4,361	3,511	2,516	1,815
Above Normal (16%)	1,323	2,651	3,693	5,447	7,960	6,141	3,574	2,529	2,982	4,854	1,863	1,539
Below Normal (13%)	1,622	2,285	2,711	2,417	5,174	2,188	2,454	2,009	2,380	4,514	1,728	1,354
Dry (24%)	1,374	1,704	1,661	1,593	2,327	2,389	2,262	1,942	2,453	2,792	1,476	1,229
Critical (15%)	1,336	1,419	1,371	1,153	938	1,041	1,313	1,362	1,542	1,546	1,125	1,012

Alternative 3_WA

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,939	3,832	9,575	12,142	14,637	9,738	6,685	7,387	4,863	5,000	2,989	1,909
20%	1,655	3,147	4,215	7,854	10,809	6,798	5,028	4,418	3,960	5,000	2,449	1,632
30%	1,500	1,964	2,610	5,547	7,335	5,026	4,424	3,523	3,638	4,979	2,017	1,533
40%	1,500	1,925	2,000	3,549	5,740	4,151	3,391	2,779	3,170	3,777	1,851	1,533
50%	1,500	1,862	2,000	1,799	3,664	3,029	2,480	2,156	2,588	3,425	1,750	1,533
60%	1,500	1,644	1,927	1,700	2,586	1,996	2,051	1,750	2,175	2,788	1,750	1,533
70%	1,372	1,385	1,490	1,700	1,445	1,747	1,747	1,601	1,787	2,527	1,609	1,480
80%	1,081	1,081	1,151	1,216	1,241	1,001	976	1,032	1,498	2,002	1,062	800
90%	800	800	800	819	960	800	800	800	914	1,151	800	590
Long Term												
Full Simulation Period ^b	1,461	2,351	3,809	5,057	5,989	4,272	3,344	3,059	2,936	3,344	1,811	1,431
Water Year Types^c												
Wet (32%)	1,664	3,256	7,197	10,526	10,590	7,191	5,483	5,490	4,293	3,443	2,464	1,796
Above Normal (16%)	1,288	2,614	3,646	5,382	7,929	6,124	3,527	2,488	2,922	4,841	1,850	1,533
Below Normal (13%)	1,589	2,232	2,635	2,391	5,137	2,176	2,408	1,969	2,299	4,491	1,714	1,368
Dry (24%)	1,346	1,666	1,631	1,573	2,259	2,371	2,196	1,897	2,386	2,712	1,447	1,209
Critical (15%)	1,281	1,357	1,353	1,106	919	1,030	1,282	1,347	1,511	1,512	1,053	961

Alternative 3_WA minus Alternative 3

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-4%	-1%	0%	0%	0%	0%	-1%	-1%	-2%	0%	-3%	-2%
20%	-3%	-2%	-3%	0%	0%	0%	-1%	-2%	-1%	0%	-4%	-3%
30%	0%	-5%	-4%	0%	-1%	0%	-1%	-1%	-1%	0%	0%	0%
40%	0%	0%	0%	-1%	0%	-1%	-3%	-2%	-1%	-2%	-1%	0%
50%	0%	-2%	0%	-5%	-1%	-1%	-3%	-4%	-3%	-3%	0%	0%
60%	0%	-2%	-2%	0%	-1%	-1%	-5%	0%	-3%	-4%	0%	0%
70%	-4%	-4%	-7%	0%	0%	0%	0%	-1%	-3%	-2%	-2%	-1%
80%	-6%	-6%	-7%	-11%	-2%	-5%	-9%	-7%	-6%	-1%	-2%	0%
90%	0%	0%	0%	-1%	-2%	0%	0%	0%	-10%	-8%	0%	-26%
Long Term												
Full Simulation Period ^b	-2%	-2%	-1%	-1%	-1%	0%	-1%	-1%	-2%	-2%	-2%	-1%
Water Year Types^c												
Wet (32%)	-2%	-1%	-1%	0%	0%	0%	-1%	-1%	-2%	-2%	-2%	-1%
Above Normal (16%)	-3%	-1%	-1%	-1%	0%	0%	-1%	-2%	-2%	0%	-1%	0%
Below Normal (13%)	-2%	-2%	-3%	-1%	-1%	-1%	-2%	-2%	-3%	-1%	-1%	1%
Dry (24%)	-2%	-2%	-2%	-1%	-3%	-1%	-3%	-2%	-3%	-3%	-2%	-2%
Critical (15%)	-4%	-4%	-1%	-4%	-2%	-1%	-2%	-1%	-2%	-2%	-6%	-5%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Note: All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.

Table 5B.3.6.2. American River d/s of Nimbus Dam, Monthly Flow

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,591	3,790	8,385	12,160	14,655	9,756	6,737	7,450	4,997	5,000	2,981	3,872
20%	1,858	3,384	3,894	7,653	10,889	6,820	5,085	4,492	3,883	5,000	2,354	3,145
30%	1,544	2,539	2,092	5,303	7,315	5,044	4,490	3,543	3,613	4,903	1,895	2,423
40%	1,500	1,961	2,000	3,582	5,758	4,175	3,491	2,733	2,886	4,084	1,750	1,910
50%	1,500	1,925	2,000	1,750	3,095	3,057	2,524	2,009	2,330	3,616	1,750	1,533
60%	1,500	1,683	1,823	1,700	1,796	2,022	2,038	1,750	1,965	2,944	1,750	1,533
70%	1,437	1,498	1,608	1,700	1,445	1,747	1,634	1,609	1,750	2,671	1,631	1,356
80%	1,188	1,219	1,262	1,356	1,264	845	1,024	992	1,508	2,392	965	800
90%	800	800	800	992	906	800	800	800	1,006	1,133	800	800
Long Term												
Full Simulation Period ^b	1,596	2,484	3,644	5,034	5,866	4,263	3,364	3,060	2,878	3,473	1,789	1,998
Water Year Types^c												
Wet (32%)	1,728	3,416	6,805	10,493	10,513	7,212	5,524	5,544	4,165	3,654	2,242	3,306
Above Normal (16%)	1,588	2,861	3,698	5,425	7,666	6,024	3,580	2,535	2,374	4,775	1,927	2,204
Below Normal (13%)	1,768	2,251	2,282	2,218	4,766	2,184	2,450	1,916	2,151	4,524	1,499	1,222
Dry (24%)	1,550	1,768	1,619	1,587	2,233	2,363	2,267	1,867	2,384	2,983	1,485	1,239
Critical (15%)	1,239	1,462	1,358	1,111	912	1,041	1,117	1,285	2,121	1,523	1,430	919

Alternative 5_WA

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,556	3,768	8,365	12,142	14,637	9,738	6,685	7,387	4,989	5,000	2,907	3,767
20%	1,819	3,380	3,841	7,630	10,889	6,803	5,028	4,425	3,790	5,000	2,346	2,981
30%	1,500	2,512	2,000	5,274	7,128	5,027	4,437	3,523	3,604	4,823	1,803	2,323
40%	1,500	1,925	2,000	3,551	5,742	4,154	3,391	2,715	2,808	4,020	1,750	1,802
50%	1,500	1,860	2,000	1,738	3,072	3,040	2,464	1,931	2,246	3,557	1,750	1,533
60%	1,500	1,682	1,809	1,700	1,858	2,001	1,997	1,750	1,907	2,839	1,750	1,533
70%	1,401	1,431	1,475	1,682	1,445	1,747	1,609	1,609	1,750	2,539	1,630	1,263
80%	1,100	1,115	1,181	1,308	1,264	823	955	959	1,498	2,105	860	804
90%	782	800	800	945	865	800	800	800	890	1,070	800	800
Long Term												
Full Simulation Period ^b	1,567	2,440	3,604	5,008	5,838	4,245	3,325	3,024	2,826	3,411	1,754	1,944
Water Year Types^c												
Wet (32%)	1,702	3,367	6,746	10,469	10,491	7,194	5,486	5,492	4,110	3,577	2,232	3,219
Above Normal (16%)	1,550	2,824	3,678	5,403	7,648	5,995	3,534	2,495	2,335	4,759	1,892	2,095
Below Normal (13%)	1,726	2,216	2,216	2,175	4,735	2,164	2,415	1,891	2,114	4,489	1,453	1,211
Dry (24%)	1,524	1,723	1,589	1,558	2,181	2,357	2,210	1,836	2,331	2,906	1,446	1,226
Critical (15%)	1,221	1,415	1,343	1,099	901	1,012	1,110	1,270	2,050	1,445	1,359	889

Alternative 5_WA minus Alternative 5

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-1%	-1%	0%	0%	0%	0%	-1%	-1%	0%	0%	-2%	-3%
20%	-2%	0%	-1%	0%	0%	0%	-1%	-1%	-2%	0%	0%	-5%
30%	-3%	-1%	-4%	-1%	-3%	0%	-1%	-1%	0%	-2%	-5%	-4%
40%	0%	-2%	0%	-1%	0%	-1%	-3%	-1%	-3%	-2%	0%	-6%
50%	0%	-3%	0%	-1%	-1%	-1%	-2%	-4%	-4%	-2%	0%	0%
60%	0%	0%	-1%	0%	3%	-1%	-2%	0%	-3%	-4%	0%	0%
70%	-3%	-4%	-8%	-1%	0%	0%	-2%	0%	0%	-5%	0%	-7%
80%	-7%	-9%	-6%	-4%	0%	-3%	-7%	-3%	-1%	-12%	-11%	0%
90%	-2%	0%	0%	-5%	-5%	0%	0%	0%	-12%	-6%	0%	0%
Long Term												
Full Simulation Period ^b	-2%	-2%	-1%	-1%	0%	0%	-1%	-1%	-2%	-2%	-2%	-3%
Water Year Types^c												
Wet (32%)	-1%	-1%	-1%	0%	0%	0%	-1%	-1%	-1%	-2%	0%	-3%
Above Normal (16%)	-2%	-1%	-1%	0%	0%	0%	-1%	-2%	-2%	0%	-2%	-5%
Below Normal (13%)	-2%	-2%	-3%	-2%	-1%	-1%	-1%	-1%	-2%	-1%	-3%	-1%
Dry (24%)	-2%	-3%	-2%	-2%	-2%	0%	-3%	-2%	-2%	-3%	-3%	-1%
Critical (15%)	-1%	-3%	-1%	-1%	-1%	-3%	-1%	-1%	-3%	-5%	-5%	-3%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Note: All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.

1 **5B.3.7. Sacramento River at Freeport Flow**

Table 5B.3.7.1. Sacramento River at Freepoint, Monthly Flow

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	14,522	22,777	54,349	64,547	70,425	63,650	46,194	38,572	19,618	24,124	16,982	15,306
20%	14,016	15,433	35,012	55,813	62,015	51,429	32,554	26,881	18,690	23,538	16,423	14,750
30%	12,928	13,874	22,439	41,575	51,558	39,917	22,941	17,225	16,622	22,859	15,633	14,073
40%	11,616	12,936	18,500	26,437	45,279	29,972	19,998	15,149	16,079	21,097	15,244	13,635
50%	10,659	12,079	15,589	22,431	33,014	24,758	16,406	13,375	15,441	19,572	14,373	13,300
60%	9,263	11,153	13,999	18,180	24,733	20,947	12,825	12,360	14,633	17,322	13,505	12,363
70%	8,269	10,294	12,891	14,734	20,406	18,647	11,997	11,712	14,169	15,486	11,575	9,959
80%	7,912	8,827	11,039	13,490	16,256	15,202	10,876	11,076	12,499	13,687	9,625	8,924
90%	6,450	7,533	9,307	11,790	14,187	11,426	10,192	9,200	11,354	10,481	8,411	6,941
Long Term												
Full Simulation Period ^b	10,882	14,066	23,134	31,069	37,948	31,691	22,137	18,659	16,634	18,450	13,425	12,156
Water Year Types^c												
Wet (32%)	12,631	18,451	38,620	50,401	56,918	48,277	35,056	30,274	21,422	19,904	15,099	14,529
Above Normal (16%)	10,011	15,687	24,282	39,084	47,607	42,363	24,359	18,074	15,986	22,756	16,372	14,207
Below Normal (13%)	11,703	14,058	15,668	19,267	31,751	19,354	14,632	14,094	15,368	22,662	16,099	13,094
Dry (24%)	10,247	10,917	13,572	17,315	23,665	21,407	15,052	12,639	14,931	16,466	10,640	10,168
Critical (15%)	8,345	8,067	11,116	14,242	15,868	12,641	10,425	8,341	10,959	10,077	8,799	7,248

Alternative 3_WA

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	14,522	22,597	54,573	64,595	70,440	63,652	46,204	38,551	19,576	24,059	16,983	15,302
20%	14,001	15,342	34,852	55,792	62,055	51,434	32,551	26,873	18,685	23,519	16,453	14,786
30%	12,914	13,898	22,398	41,583	51,560	40,594	22,928	17,225	16,611	22,903	15,661	14,073
40%	11,693	12,952	18,395	26,428	45,289	29,973	19,889	15,154	16,060	21,039	15,298	13,660
50%	10,717	12,046	15,530	22,279	32,969	24,754	16,407	13,378	15,457	19,538	14,357	13,322
60%	9,353	11,121	13,811	18,195	24,732	20,972	12,917	12,390	14,631	17,346	13,441	12,299
70%	8,214	10,221	12,802	14,746	20,413	18,634	11,988	11,714	14,181	15,374	11,535	9,914
80%	7,912	8,717	11,043	13,550	16,276	15,231	10,916	11,076	12,409	13,629	9,639	8,918
90%	6,450	7,551	9,303	11,820	14,220	11,459	10,235	9,201	11,355	10,430	8,552	6,963
Long Term												
Full Simulation Period ^b	10,892	14,051	23,085	31,051	37,940	31,702	22,126	18,660	16,618	18,429	13,421	12,151
Water Year Types^c												
Wet (32%)	12,647	18,424	38,609	50,384	56,924	48,279	35,051	30,261	21,403	19,893	15,068	14,530
Above Normal (16%)	10,014	15,687	24,067	39,036	47,615	42,396	24,345	18,080	15,983	22,762	16,378	14,189
Below Normal (13%)	11,739	14,031	15,607	19,256	31,751	19,364	14,631	14,089	15,347	22,693	16,100	13,093
Dry (24%)	10,262	10,905	13,568	17,315	23,614	21,416	15,028	12,651	14,911	16,390	10,614	10,162
Critical (15%)	8,314	8,064	11,100	14,217	15,877	12,652	10,420	8,355	10,948	10,056	8,870	7,240

Alternative 3_WA minus Alternative 3

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	2%	0%	0%	0%	0%	0%	0%
40%	1%	0%	-1%	0%	0%	0%	-1%	0%	0%	0%	0%	0%
50%	1%	0%	0%	-1%	0%	0%	0%	0%	0%	0%	0%	0%
60%	1%	0%	-1%	0%	0%	0%	1%	0%	0%	0%	0%	-1%
70%	-1%	-1%	-1%	0%	0%	0%	0%	0%	0%	-1%	0%	0%
80%	0%	-1%	0%	0%	0%	0%	0%	0%	-1%	0%	0%	0%
90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	2%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	0%

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Note: All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.

Table 5B.3.7.2. Sacramento River at Freeport, Monthly Flow

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	14,940	22,403	48,958	63,738	70,363	62,025	46,178	38,574	19,953	24,625	17,185	29,151
20%	13,753	18,981	32,387	52,655	61,599	51,038	32,559	25,815	16,141	24,012	16,842	28,386
30%	13,111	18,329	21,304	38,363	49,567	37,212	22,950	16,490	13,942	23,249	16,214	22,293
40%	11,971	16,727	17,992	24,503	42,844	29,460	20,004	12,900	13,403	21,099	15,960	21,312
50%	10,996	15,185	15,541	20,791	32,715	24,379	15,901	11,905	13,055	19,737	15,468	14,746
60%	9,175	13,119	15,099	18,100	24,483	20,700	12,517	11,096	12,619	18,365	14,543	13,155
70%	8,302	10,026	13,584	14,777	19,202	18,200	11,777	10,131	12,094	17,451	11,864	10,306
80%	7,912	8,595	10,753	13,467	16,241	14,863	10,304	9,401	10,762	15,630	9,789	8,689
90%	6,444	7,512	9,293	11,701	13,900	11,364	9,585	8,003	10,127	11,885	8,975	7,378
Long Term												
Full Simulation Period ^b	11,003	15,715	22,497	30,404	37,388	31,223	21,901	17,523	14,824	19,224	13,951	17,409
Water Year Types^c												
Wet (32%)	12,973	20,552	36,278	49,232	56,574	48,034	35,045	29,921	20,050	20,717	16,120	27,839
Above Normal (16%)	10,196	17,255	24,677	38,449	46,580	40,841	24,141	16,617	13,618	23,104	16,859	21,070
Below Normal (13%)	12,003	15,829	15,766	18,240	30,181	18,617	14,146	12,152	12,755	22,395	15,727	12,486
Dry (24%)	10,157	12,669	13,658	17,178	23,432	21,280	14,835	10,813	12,951	17,695	11,049	10,285
Critical (15%)	8,100	8,542	11,179	14,090	15,730	12,507	9,883	7,752	9,826	11,428	9,309	7,230

Alternative 5_WA

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	14,939	22,317	49,006	63,715	70,379	62,013	46,174	38,552	19,936	24,654	17,184	29,026
20%	13,754	18,988	32,533	52,689	61,606	51,039	32,558	25,656	16,092	24,038	16,866	28,236
30%	13,072	18,328	21,226	38,367	49,249	37,198	22,936	16,518	13,940	23,268	16,214	22,324
40%	11,951	16,821	17,967	24,529	42,874	29,426	19,897	12,902	13,400	21,094	15,951	21,304
50%	11,010	15,177	15,551	20,785	32,688	24,390	15,905	11,894	13,107	19,751	15,453	14,728
60%	9,173	13,106	15,119	18,061	24,509	20,711	12,491	11,125	12,679	18,366	14,626	13,076
70%	8,292	10,039	13,535	14,786	19,204	18,221	11,812	10,128	12,071	17,551	11,851	10,308
80%	7,912	8,609	10,772	13,485	16,261	14,895	10,336	9,396	10,762	15,578	9,756	8,589
90%	6,444	7,525	9,274	11,723	13,914	11,394	9,606	8,001	10,117	11,784	8,969	7,372
Long Term												
Full Simulation Period ^b	10,992	15,703	22,482	30,398	37,387	31,226	21,894	17,524	14,835	19,215	13,932	17,385
Water Year Types^c												
Wet (32%)	12,942	20,520	36,264	49,222	56,587	48,038	35,042	29,908	20,086	20,718	16,108	27,764
Above Normal (16%)	10,181	17,223	24,671	38,454	46,578	40,822	24,125	16,618	13,613	23,142	16,852	21,065
Below Normal (13%)	12,007	15,813	15,724	18,216	30,172	18,608	14,142	12,148	12,760	22,380	15,781	12,497
Dry (24%)	10,165	12,686	13,646	17,171	23,407	21,294	14,812	10,821	12,949	17,661	10,998	10,288
Critical (15%)	8,094	8,546	11,171	14,098	15,742	12,520	9,903	7,772	9,830	11,392	9,249	7,221

Alternative 5_WA minus Alternative 5

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	-1%	0%	0%	0%	-1%
30%	0%	0%	0%	0%	-1%	0%	0%	0%	0%	0%	0%	0%
40%	0%	1%	0%	0%	0%	0%	-1%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	-1%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%
90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	0%

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Note: All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.

1 **5B.3.8. Delta Outflow**

Table 5B.3.8.1. Sacramento/San Joaquin River Delta Outflow, Monthly Outflow Volume

Alternative 3

Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	298	902	4,155	6,646	7,924	5,788	3,812	2,471	1,066	729	265	261
20%	266	389	2,140	4,462	4,802	4,293	2,584	1,383	630	659	246	245
30%	257	319	1,154	3,104	3,795	2,714	1,525	913	572	575	246	235
40%	246	290	722	1,875	3,031	2,137	1,238	750	502	492	246	229
50%	246	268	480	1,398	2,079	1,678	867	704	477	492	246	222
60%	246	268	398	1,061	1,416	1,185	754	630	436	428	246	191
70%	246	268	336	768	1,078	1,032	601	579	422	307	246	179
80%	246	268	277	599	821	789	566	493	409	307	241	179
90%	185	208	277	497	634	654	512	437	351	246	222	179
Long Term												
Full Simulation Period ^b	277	506	1,465	2,772	3,236	2,711	1,617	1,122	656	490	252	240
Water Year Types^c												
Wet (32%)	333	791	3,116	5,609	5,812	5,020	2,996	2,109	1,118	649	271	319
Above Normal (16%)	242	568	1,461	3,096	3,903	3,292	1,636	960	514	645	246	228
Below Normal (13%)	281	422	564	1,156	2,186	1,120	856	699	457	507	254	221
Dry (24%)	250	297	457	992	1,459	1,384	882	612	445	321	245	191
Critical (15%)	234	243	397	721	859	752	528	397	346	246	230	179

Alternative 3_WA

Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	313	890	4,169	6,646	7,923	5,788	3,820	2,470	1,064	724	266	261
20%	266	376	2,137	4,462	4,818	4,300	2,584	1,382	629	660	246	245
30%	255	317	1,154	3,104	3,795	2,775	1,524	912	572	578	246	235
40%	246	291	721	1,876	3,031	2,138	1,225	750	502	492	246	228
50%	246	268	479	1,384	2,072	1,680	865	704	475	492	246	223
60%	246	268	399	1,058	1,414	1,186	752	631	436	428	246	187
70%	246	268	319	767	1,081	1,027	598	577	422	307	246	179
80%	246	268	277	603	822	791	568	492	409	307	239	179
90%	185	208	277	498	636	655	514	437	350	246	222	179
Long Term												
Full Simulation Period ^b	277	505	1,464	2,771	3,237	2,713	1,616	1,122	656	490	252	240
Water Year Types^c												
Wet (32%)	335	788	3,116	5,608	5,811	5,019	2,996	2,108	1,117	649	271	319
Above Normal (16%)	243	568	1,455	3,093	3,909	3,297	1,635	960	514	645	246	227
Below Normal (13%)	280	421	560	1,155	2,186	1,120	855	699	455	508	254	221
Dry (24%)	250	297	457	992	1,456	1,385	881	611	445	321	244	191
Critical (15%)	234	243	397	721	861	753	529	398	346	246	228	179

Alternative 3_WA minus Alternative 3

Statistic	Monthly Outflow Volume (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	5%	-1%	0%	0%	0%	0%	0%	0%	0%	-1%	0%	0%
20%	0%	-3%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	-1%	-1%	0%	0%	0%	2%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	-1%	0%	0%	0%	0%	0%
50%	0%	0%	0%	-1%	0%	0%	0%	0%	0%	0%	0%	1%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-2%
70%	0%	0%	-5%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	1%	0%	0%	0%	0%	0%	0%	-1%	0%
90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Note: All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.

Table 5B.3.8.2. Sacramento/San Joaquin River Delta Outflow, Monthly Outflow Volume

Alternative 5

Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	623	960	4,115	6,339	7,831	5,439	4,160	2,849	1,180	767	284	1,161
20%	594	874	2,112	4,319	4,907	4,174	2,807	1,763	606	688	256	1,134
30%	576	830	1,008	3,149	3,653	2,835	1,798	1,237	524	593	246	910
40%	423	660	762	1,785	2,869	2,092	1,542	1,002	453	501	246	651
50%	257	586	616	1,301	2,053	1,666	1,234	873	423	492	246	255
60%	246	369	359	1,048	1,406	1,203	1,028	776	422	400	246	204
70%	246	268	310	800	1,025	1,057	817	629	401	308	246	179
80%	246	268	286	585	823	783	712	561	370	307	246	179
90%	184	211	277	486	633	662	623	462	330	246	230	179
Long Term												
Full Simulation Period ^b	401	690	1,413	2,714	3,184	2,695	1,848	1,312	642	500	257	565
Water Year Types^c												
Wet (32%)	517	1,020	2,905	5,499	5,773	4,996	3,288	2,411	1,117	667	273	1,132
Above Normal (16%)	334	767	1,505	3,048	3,795	3,232	1,947	1,223	482	668	251	661
Below Normal (13%)	471	650	582	1,075	2,047	1,110	1,061	821	434	513	254	214
Dry (24%)	342	471	467	980	1,444	1,396	1,081	720	423	316	256	191
Critical (15%)	254	296	418	714	856	747	621	462	346	249	233	179

Alternative 5_WA

Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	614	893	4,109	6,332	7,834	5,439	4,159	2,847	1,178	767	284	1,161
20%	594	874	2,123	4,318	4,907	4,176	2,807	1,762	605	701	258	1,134
30%	576	819	1,007	3,149	3,645	2,833	1,797	1,235	525	593	246	910
40%	423	660	763	1,785	2,870	2,092	1,538	1,001	449	502	246	651
50%	256	586	616	1,301	2,054	1,667	1,226	873	422	492	246	256
60%	246	369	360	1,048	1,407	1,204	1,027	777	422	400	246	205
70%	246	268	310	801	1,023	1,061	816	630	401	308	246	179
80%	246	268	286	587	824	785	709	561	370	307	246	179
90%	184	211	277	488	633	664	627	464	330	246	230	179
Long Term												
Full Simulation Period ^b	400	685	1,413	2,714	3,185	2,695	1,848	1,312	642	500	257	565
Water Year Types^c												
Wet (32%)	516	1,018	2,906	5,498	5,775	4,995	3,288	2,410	1,115	668	272	1,132
Above Normal (16%)	333	736	1,504	3,048	3,797	3,229	1,946	1,223	482	669	251	661
Below Normal (13%)	471	649	579	1,073	2,046	1,111	1,061	821	434	513	254	214
Dry (24%)	342	471	468	980	1,443	1,396	1,079	721	422	316	256	192
Critical (15%)	254	296	417	714	856	747	622	463	346	248	233	179

Alternative 5_WA minus Alternative 5

Statistic	Monthly Outflow Volume (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-1%	-7%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	1%	0%	0%	0%	0%	0%	0%	2%	1%	0%
30%	0%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	-1%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
90%	0%	0%	0%	0%	0%	0%	1%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	-4%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Note: All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.

1 **5B.3.9. Jones and Banks Export Volume**

Table 5B.3.9.1. Exports Through Jones and Banks Pumping Plants, Monthly Export Volume

Alternative 3

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	694	671	718	653	725	722	547	563	667	694	694	671
20%	673	671	691	565	603	622	510	496	461	694	694	671
30%	627	652	628	440	524	577	465	452	399	694	694	671
40%	552	627	583	422	449	532	437	386	373	680	694	657
50%	476	571	546	411	393	460	369	329	355	628	624	640
60%	382	501	523	395	365	351	320	281	338	566	502	572
70%	322	467	505	377	320	316	255	230	311	448	396	417
80%	265	346	479	328	264	288	187	124	252	382	268	344
90%	218	276	378	304	202	159	124	102	138	190	170	228
Long Term												
Full Simulation Period ^b	465	520	549	442	426	445	353	330	362	533	513	529
Water Year Types^c												
Wet (32%)	544	615	601	559	594	589	494	490	519	648	667	654
Above Normal (16%)	430	533	574	414	469	566	441	413	397	586	680	647
Below Normal (13%)	524	587	607	394	373	448	312	266	330	683	650	588
Dry (24%)	440	471	523	389	314	337	270	242	292	492	318	426
Critical (15%)	321	319	401	355	251	180	127	100	131	158	196	245

Alternative 3_WA

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	694	671	718	653	726	722	542	563	667	696	694	671
20%	672	671	690	565	603	622	512	496	461	694	694	671
30%	628	660	620	440	524	576	465	451	399	694	694	671
40%	552	624	582	422	449	532	438	386	373	680	694	657
50%	475	571	545	411	393	460	369	329	355	630	619	640
60%	397	501	521	395	365	351	320	280	339	566	498	555
70%	316	467	505	373	320	316	256	231	311	448	392	420
80%	265	344	479	328	264	288	186	124	252	379	269	343
90%	219	276	378	304	202	159	124	102	136	189	189	230
Long Term												
Full Simulation Period ^b	465	520	548	442	426	444	353	330	362	532	513	528
Water Year Types^c												
Wet (32%)	544	616	601	558	594	589	493	491	519	648	665	654
Above Normal (16%)	430	534	567	414	469	562	442	413	397	586	680	647
Below Normal (13%)	526	586	608	394	373	448	313	266	330	684	650	588
Dry (24%)	441	471	523	390	314	337	270	243	290	488	317	426
Critical (15%)	319	320	401	354	249	180	126	100	131	157	202	245

Alternative 3_WA minus Alternative 3

Statistic	Monthly Export Volume (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	-1%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	1%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	0%
60%	4%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	-3%
70%	-2%	0%	0%	-1%	0%	0%	0%	1%	0%	0%	-1%	1%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	0%	0%
90%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	0%	11%	1%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	-1%	0%	0%	-1%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	0%	0%
Critical (15%)	0%	0%	0%	0%	-1%	0%	-1%	0%	-1%	-1%	3%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Note: All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.

Table 5B.3.9.2. Exports Through Jones and Banks Pumping Plants, Monthly Export Volume

Alternative 5

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	514	671	721	604	613	677	223	218	509	714	724	671
20%	454	553	717	490	528	612	165	127	359	709	724	662
30%	429	479	685	427	448	528	134	91	340	696	715	648
40%	378	443	558	419	416	479	122	83	318	678	705	626
50%	360	408	496	405	380	424	111	71	251	646	693	598
60%	334	375	481	396	363	349	97	50	207	606	571	508
70%	311	347	452	377	323	312	80	38	193	568	401	415
80%	289	302	387	319	267	283	45	23	178	445	278	347
90%	245	250	337	280	165	159	30	7	42	271	192	254
Long Term												
Full Simulation Period ^b	376	427	528	427	394	423	122	99	279	570	538	514
Water Year Types^c												
Wet (32%)	408	505	564	514	532	592	202	202	444	667	718	627
Above Normal (16%)	376	423	561	407	405	496	127	92	315	590	705	625
Below Normal (13%)	381	456	588	387	359	397	103	55	208	663	632	561
Dry (24%)	370	394	513	392	315	318	80	41	205	577	333	433
Critical (15%)	313	293	382	355	249	179	34	20	69	239	222	243

Alternative 5_WA

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	513	671	721	604	607	678	223	218	509	714	724	671
20%	454	567	717	490	529	611	165	127	359	709	724	661
30%	432	493	685	427	448	517	134	91	340	695	715	647
40%	377	447	558	419	412	479	122	83	319	679	700	616
50%	360	415	497	405	380	424	111	71	268	647	693	590
60%	334	375	477	396	363	349	97	50	207	606	586	518
70%	312	349	453	377	323	312	80	38	193	566	390	416
80%	288	306	389	319	267	283	45	23	178	445	276	349
90%	247	251	337	280	165	160	30	7	42	266	193	254
Long Term												
Full Simulation Period ^b	376	432	527	427	394	423	122	99	280	569	537	513
Water Year Types^c												
Wet (32%)	407	504	564	514	532	592	202	202	448	667	717	622
Above Normal (16%)	376	451	562	407	404	496	127	92	315	591	705	625
Below Normal (13%)	381	456	588	387	359	396	103	55	208	662	635	561
Dry (24%)	370	395	512	391	315	318	80	41	205	575	331	433
Critical (15%)	312	293	382	356	250	179	33	20	69	237	219	243

Alternative 5_WA minus Alternative 5

Statistic	Monthly Export Volume (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	-1%	0%	0%	0%	0%	0%	0%	0%
20%	0%	2%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	1%	3%	0%	0%	0%	-2%	0%	0%	0%	0%	0%	0%
40%	0%	1%	0%	0%	-1%	0%	0%	0%	0%	0%	-1%	-2%
50%	0%	2%	0%	0%	0%	0%	0%	0%	7%	0%	0%	-1%
60%	0%	0%	-1%	0%	0%	0%	0%	0%	0%	0%	3%	2%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-3%	0%
80%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	1%
90%	1%	0%	0%	0%	0%	0%	0%	0%	0%	-2%	1%	0%
Long Term												
Full Simulation Period ^b	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	1%	0%	0%	-1%
Above Normal (16%)	0%	7%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	-1%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Note: All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.

1 **5B.3.10. American River below Nimbus Temperature**

Table 5B.3.10.1. American River below Nimbus Dam, Monthly Temperature

Alternative 3

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	66.2	58.1	53.3	48.3	48.8	52.2	58.0	63.2	67.8	68.7	67.3	68.0
20%	65.2	57.9	52.0	47.6	47.8	51.3	56.9	62.0	65.3	66.7	66.3	67.4
30%	64.4	57.6	51.7	47.2	47.5	50.7	56.2	60.7	64.6	65.3	65.6	66.5
40%	63.6	57.3	50.7	46.9	47.0	49.9	55.3	59.6	63.1	64.8	64.9	65.9
50%	63.3	57.1	50.5	46.3	46.7	49.4	54.5	58.3	62.4	64.5	64.2	65.3
60%	63.1	56.9	49.4	45.8	46.3	49.0	54.0	57.8	60.8	64.4	64.0	64.9
70%	62.8	56.6	48.9	45.6	46.0	48.7	53.4	57.0	59.8	64.1	63.2	64.6
80%	62.6	56.1	48.3	45.0	45.8	48.3	52.4	56.5	59.3	63.7	62.7	64.0
90%	59.2	55.7	47.1	44.5	45.4	48.0	51.9	54.9	59.0	63.4	62.2	63.4
Long Term												
Full Simulation Period ^b	63.4	57.0	50.2	46.4	46.9	49.8	54.8	59.1	62.5	65.3	64.5	65.6
Water Year Types^c												
Wet (32%)	60.1	54.4	47.6	45.7	46.1	48.6	52.8	56.6	60.0	63.9	62.6	64.0
Above Normal (16%)	63.7	56.8	49.8	46.4	46.6	49.0	54.2	58.3	62.1	64.2	64.3	65.1
Below Normal (13%)	62.4	56.9	51.1	47.0	46.9	50.0	56.0	60.6	63.4	65.0	64.9	66.0
Dry (24%)	63.9	57.3	50.7	46.7	47.3	50.6	55.5	60.5	63.7	65.9	65.6	66.3
Critical (15%)	64.9	57.7	50.7	46.8	48.1	52.1	57.2	61.5	65.6	69.0	67.0	68.0

Alternative 3_WA

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	66.3	58.1	53.2	48.2	48.6	52.3	57.9	63.3	67.5	68.8	67.3	68.1
20%	65.1	57.8	51.8	47.4	47.8	51.4	57.0	61.8	65.5	66.9	66.4	67.5
30%	64.3	57.6	51.5	47.2	47.5	50.7	56.2	61.0	64.9	65.2	65.7	66.6
40%	63.5	57.4	50.7	46.9	47.0	49.9	55.2	59.6	63.2	64.8	65.0	65.9
50%	63.2	57.1	50.4	46.2	46.7	49.4	54.6	58.4	62.4	64.6	64.4	65.4
60%	62.9	56.8	49.4	45.8	46.3	49.0	54.0	57.8	60.8	64.4	63.9	64.9
70%	62.7	56.5	48.9	45.5	46.0	48.7	53.4	57.0	59.8	64.1	63.1	64.6
80%	62.5	56.0	48.2	45.0	45.8	48.3	52.4	56.5	59.3	63.6	62.8	64.1
90%	59.1	55.6	46.9	44.5	45.4	48.0	51.9	54.9	59.0	63.4	62.2	63.5
Long Term												
Full Simulation Period ^b	63.4	56.9	50.1	46.3	46.8	49.8	54.7	59.0	62.6	65.3	64.6	65.6
Water Year Types^c												
Wet (32%)	60.1	54.4	47.5	45.7	46.1	48.6	52.8	56.6	60.0	63.8	62.7	64.0
Above Normal (16%)	63.7	56.8	49.7	46.4	46.6	49.0	54.2	58.3	62.1	64.2	64.4	65.1
Below Normal (13%)	62.0	56.5	51.0	46.9	46.9	50.0	56.1	60.4	63.5	65.0	64.8	65.9
Dry (24%)	63.9	57.3	50.6	46.6	47.3	50.6	55.5	60.6	63.9	65.9	65.6	66.4
Critical (15%)	65.0	57.7	50.7	46.7	48.1	52.1	57.1	61.3	65.5	69.0	67.2	68.1

Alternative 3_WA minus Alternative 3

Statistic	Monthly Temperature (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	-1%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Note: All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.

Table 5B.3.10.2. American River below Nimbus Dam, Monthly Temperature

Alternative 5

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	66.3	58.0	53.3	47.9	48.6	52.4	57.8	62.8	67.6	68.4	67.3	68.3
20%	65.3	57.8	51.9	47.3	47.8	51.7	56.9	61.7	65.9	66.7	66.7	67.5
30%	64.4	57.6	51.2	46.9	47.4	50.6	56.0	60.7	64.6	65.3	65.7	66.5
40%	63.5	57.3	50.7	46.8	46.9	49.8	55.3	59.5	63.1	64.9	65.0	65.7
50%	63.3	57.1	50.4	46.3	46.6	49.4	54.5	58.3	61.9	64.6	64.2	65.3
60%	63.1	56.8	49.2	45.8	46.3	49.0	54.0	57.8	60.6	64.5	63.8	64.8
70%	62.8	56.5	48.5	45.4	46.0	48.7	53.4	57.0	59.7	64.3	63.4	64.4
80%	62.6	56.1	48.0	44.9	45.8	48.3	52.4	56.5	59.3	63.7	63.1	64.1
90%	59.2	55.6	46.9	44.5	45.4	48.0	51.9	54.9	59.0	63.5	62.6	63.0
Long Term												
Full Simulation Period ^b	63.4	57.0	50.0	46.2	46.8	49.9	54.7	59.0	62.5	65.2	64.7	65.5
Water Year Types^c												
Wet (32%)	60.1	54.5	47.3	45.6	46.0	48.6	52.8	56.6	59.9	63.8	62.9	63.7
Above Normal (16%)	63.9	56.8	49.8	46.2	46.5	49.0	54.2	58.3	61.8	64.5	64.1	65.0
Below Normal (13%)	62.3	56.6	50.6	46.5	46.7	50.0	56.1	60.2	63.6	65.1	65.3	65.7
Dry (24%)	63.9	57.3	50.5	46.6	47.3	50.6	55.4	60.2	63.8	65.8	65.6	66.4
Critical (15%)	64.8	57.5	50.6	46.7	48.1	52.3	57.0	61.8	65.8	68.3	67.1	68.2

Alternative 5_WA

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	66.4	58.1	54.0	48.2	48.6	52.5	57.7	62.8	67.3	68.6	67.3	68.0
20%	65.0	57.6	52.6	47.5	47.8	51.8	56.9	61.8	65.5	66.1	66.5	67.1
30%	63.4	57.4	51.6	47.2	47.5	50.7	56.0	60.7	64.7	65.0	65.3	65.8
40%	63.1	57.0	51.2	46.9	46.9	49.7	55.2	59.5	63.1	64.3	64.7	65.2
50%	62.8	56.8	50.6	46.3	46.7	49.4	54.5	58.3	61.8	63.9	63.6	64.3
60%	62.5	56.5	49.5	45.8	46.3	49.0	54.0	57.8	60.5	63.7	63.1	63.5
70%	59.4	56.4	48.7	45.5	46.0	48.7	53.4	56.9	59.8	63.4	62.8	63.1
80%	58.9	56.2	48.2	44.9	45.8	48.3	52.4	56.3	59.3	62.9	62.3	62.5
90%	58.5	55.7	46.9	44.5	45.4	48.0	51.9	54.9	59.0	62.4	61.0	61.3
Long Term												
Full Simulation Period ^b	62.2	56.9	50.4	46.4	46.8	49.9	54.7	59.0	62.4	64.7	64.1	64.5
Water Year Types^c												
Wet (32%)	59.4	54.6	47.5	45.7	46.0	48.5	52.7	56.6	59.8	62.9	61.8	62.1
Above Normal (16%)	62.1	57.0	50.5	46.5	46.6	49.0	54.2	58.3	61.8	63.8	63.4	63.9
Below Normal (13%)	60.4	56.1	51.2	46.7	46.7	50.0	56.0	59.9	63.3	64.6	64.8	64.9
Dry (24%)	62.8	57.1	50.9	46.7	47.3	50.7	55.5	60.3	63.7	65.5	65.3	65.9
Critical (15%)	63.9	57.3	50.8	46.8	48.1	52.4	57.1	61.9	65.9	68.1	67.4	68.0

Alternative 5_WA minus Alternative 5

Statistic	Monthly Temperature (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	1%	1%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	1%	0%	0%	0%	0%	0%	-1%	-1%	0%	-1%
30%	-1%	0%	1%	1%	0%	0%	0%	0%	0%	0%	-1%	-1%
40%	-1%	0%	1%	0%	0%	0%	0%	0%	0%	-1%	-1%	-1%
50%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	-1%	-1%
60%	-1%	-1%	1%	0%	0%	0%	0%	0%	0%	-1%	-1%	-2%
70%	-5%	0%	1%	0%	0%	0%	0%	0%	0%	-1%	-1%	-2%
80%	-6%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	-1%	-2%
90%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	-2%	-2%	-3%
Long Term												
Full Simulation Period ^b	-2%	0%	1%	0%	0%	0%	0%	0%	0%	-1%	-1%	-1%
Water Year Types^c												
Wet (32%)	-1%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	-2%	-3%
Above Normal (16%)	-3%	0%	1%	1%	0%	0%	0%	0%	0%	-1%	-1%	-2%
Below Normal (13%)	-3%	-1%	1%	0%	0%	0%	0%	0%	-1%	-1%	-1%	-1%
Dry (24%)	-2%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	-1%
Critical (15%)	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Note: All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.

1 **5B.3.11. American River at Watt Temperature**

Table 5B.3.11.1. American River at Watt Avenue, Monthly Temperature

Alternative 3

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	67.1	58.3	52.6	48.7	50.1	56.4	62.7	67.9	72.5	73.0	73.4	71.4
20%	65.7	57.9	51.7	48.0	49.5	54.7	60.2	66.4	69.2	70.0	71.6	70.2
30%	64.9	57.6	51.3	47.6	48.7	53.0	59.2	65.3	68.2	68.7	69.8	69.1
40%	64.5	57.3	50.4	47.4	48.3	51.9	57.7	63.8	66.8	68.2	69.0	68.6
50%	64.1	57.0	50.3	46.7	47.8	51.3	57.0	62.3	65.9	67.8	68.5	67.9
60%	63.7	56.7	49.5	46.4	47.3	50.5	56.5	61.0	64.5	67.5	67.9	67.6
70%	63.4	56.5	48.8	45.9	46.9	50.0	55.0	59.8	63.6	67.1	67.4	67.3
80%	63.0	56.1	48.2	45.3	46.5	49.7	54.2	59.1	62.9	67.0	66.2	66.7
90%	60.7	55.8	47.3	44.9	46.1	49.2	53.4	57.1	61.9	66.4	65.6	65.8
Long Term												
Full Simulation Period ^b	64.1	57.0	50.0	46.8	48.1	52.0	57.4	62.7	66.3	68.9	69.0	68.4
Water Year Types^c												
Wet (32%)	60.8	54.5	47.5	46.0	46.8	49.9	54.7	59.3	63.2	67.4	66.5	66.7
Above Normal (16%)	64.6	57.0	49.8	46.8	47.5	50.4	56.3	62.0	65.8	67.0	68.4	67.7
Below Normal (13%)	63.2	56.7	50.7	47.3	47.9	52.5	59.1	64.1	67.4	67.7	69.3	68.8
Dry (24%)	64.5	57.2	50.3	47.2	48.8	53.2	58.6	64.4	67.7	69.5	70.2	69.2
Critical (15%)	65.6	57.7	50.3	47.4	50.5	55.5	61.3	66.3	70.5	74.4	72.6	71.3

Alternative 3_WA

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	67.2	58.2	52.5	48.7	50.1	56.4	62.5	68.0	72.7	73.3	73.4	71.5
20%	65.7	57.9	51.6	48.0	49.5	54.7	60.6	66.3	69.5	70.4	71.6	70.1
30%	64.9	57.6	51.1	47.6	48.7	53.0	59.1	65.5	68.5	68.7	70.1	69.4
40%	64.5	57.2	50.4	47.4	48.2	51.9	57.9	63.9	66.8	68.3	69.1	68.8
50%	64.2	57.0	50.1	46.7	47.7	51.3	57.0	62.2	65.9	68.0	68.4	67.9
60%	63.7	56.7	49.4	46.4	47.3	50.5	56.5	61.0	64.5	67.5	68.0	67.6
70%	63.3	56.5	48.8	45.9	46.9	50.0	55.0	59.8	63.7	67.1	67.3	67.3
80%	63.0	56.0	48.1	45.3	46.5	49.7	54.2	59.1	63.0	66.9	66.3	66.7
90%	60.7	55.6	47.3	44.9	46.2	49.2	53.4	57.1	62.0	66.4	65.9	65.9
Long Term												
Full Simulation Period ^b	64.1	57.0	49.9	46.8	48.1	52.0	57.5	62.7	66.5	69.0	69.1	68.5
Water Year Types^c												
Wet (32%)	60.9	54.5	47.4	46.0	46.8	49.9	54.7	59.3	63.3	67.5	66.6	66.7
Above Normal (16%)	64.6	57.0	49.8	46.8	47.5	50.4	56.4	62.0	65.8	67.0	68.5	67.7
Below Normal (13%)	63.0	56.4	50.6	47.3	47.9	52.5	59.2	64.1	67.6	67.8	69.3	68.8
Dry (24%)	64.5	57.2	50.2	47.1	48.8	53.2	58.6	64.6	67.9	69.6	70.3	69.3
Critical (15%)	65.7	57.7	50.2	47.4	50.5	55.5	61.3	66.3	70.6	74.4	73.0	71.5

Alternative 3_WA minus Alternative 3

Statistic	Monthly Temperature (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	1%	0%	0%	1%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Note: All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.

Table 5B.3.11.2. American River at Watt Avenue, Monthly Temperature

Alternative 5

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	66.3	58.0	53.3	47.9	48.6	52.4	57.8	62.8	67.6	68.4	67.3	68.3
20%	65.3	57.8	51.9	47.3	47.8	51.7	56.9	61.7	65.9	66.7	66.7	67.5
30%	64.4	57.6	51.2	46.9	47.4	50.6	56.0	60.7	64.6	65.3	65.7	66.5
40%	63.5	57.3	50.7	46.8	46.9	49.8	55.3	59.5	63.1	64.9	65.0	65.7
50%	63.3	57.1	50.4	46.3	46.6	49.4	54.5	58.3	61.9	64.6	64.2	65.3
60%	63.1	56.8	49.2	45.8	46.3	49.0	54.0	57.8	60.6	64.5	63.8	64.8
70%	62.8	56.5	48.5	45.4	46.0	48.7	53.4	57.0	59.7	64.3	63.4	64.4
80%	62.6	56.1	48.0	44.9	45.8	48.3	52.4	56.5	59.3	63.7	63.1	64.1
90%	59.2	55.6	46.9	44.5	45.4	48.0	51.9	54.9	59.0	63.5	62.6	63.0
Long Term												
Full Simulation Period ^b	63.4	57.0	50.0	46.2	46.8	49.9	54.7	59.0	62.5	65.2	64.7	65.5
Water Year Types^c												
Wet (32%)	60.1	54.5	47.3	45.6	46.0	48.6	52.8	56.6	59.9	63.8	62.9	63.7
Above Normal (16%)	63.9	56.8	49.8	46.2	46.5	49.0	54.2	58.3	61.8	64.5	64.1	65.0
Below Normal (13%)	62.3	56.6	50.6	46.5	46.7	50.0	56.1	60.2	63.6	65.1	65.3	65.7
Dry (24%)	63.9	57.3	50.5	46.6	47.3	50.6	55.4	60.2	63.8	65.8	65.6	66.4
Critical (15%)	64.8	57.5	50.6	46.7	48.1	52.3	57.0	61.8	65.8	68.3	67.1	68.2

Alternative 5_WA

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	66.4	58.1	54.0	48.2	48.6	52.5	57.7	62.8	67.3	68.6	67.3	68.0
20%	65.0	57.6	52.6	47.5	47.8	51.8	56.9	61.8	65.5	66.1	66.5	67.1
30%	63.4	57.4	51.6	47.2	47.5	50.7	56.0	60.7	64.7	65.0	65.3	65.8
40%	63.1	57.0	51.2	46.9	46.9	49.7	55.2	59.5	63.1	64.3	64.7	65.2
50%	62.8	56.8	50.6	46.3	46.7	49.4	54.5	58.3	61.8	63.9	63.6	64.3
60%	62.5	56.5	49.5	45.8	46.3	49.0	54.0	57.8	60.5	63.7	63.1	63.5
70%	59.4	56.4	48.7	45.5	46.0	48.7	53.4	56.9	59.8	63.4	62.8	63.1
80%	58.9	56.2	48.2	44.9	45.8	48.3	52.4	56.3	59.3	62.9	62.3	62.5
90%	58.5	55.7	46.9	44.5	45.4	48.0	51.9	54.9	59.0	62.4	61.0	61.3
Long Term												
Full Simulation Period ^b	62.2	56.9	50.4	46.4	46.8	49.9	54.7	59.0	62.4	64.7	64.1	64.5
Water Year Types^c												
Wet (32%)	59.4	54.6	47.5	45.7	46.0	48.5	52.7	56.6	59.8	62.9	61.8	62.1
Above Normal (16%)	62.1	57.0	50.5	46.5	46.6	49.0	54.2	58.3	61.8	63.8	63.4	63.9
Below Normal (13%)	60.4	56.1	51.2	46.7	46.7	50.0	56.0	59.9	63.3	64.6	64.8	64.9
Dry (24%)	62.8	57.1	50.9	46.7	47.3	50.7	55.5	60.3	63.7	65.5	65.3	65.9
Critical (15%)	63.9	57.3	50.8	46.8	48.1	52.4	57.1	61.9	65.9	68.1	67.4	68.0

Alternative 5_WA minus Alternative 5

Statistic	Monthly Temperature (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	1%	1%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	1%	0%	0%	0%	0%	0%	-1%	-1%	0%	-1%
30%	-1%	0%	1%	1%	0%	0%	0%	0%	0%	0%	-1%	-1%
40%	-1%	0%	1%	0%	0%	0%	0%	0%	0%	-1%	-1%	-1%
50%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	-1%	-1%
60%	-1%	-1%	1%	0%	0%	0%	0%	0%	0%	-1%	-1%	-2%
70%	-5%	0%	1%	0%	0%	0%	0%	0%	0%	-1%	-1%	-2%
80%	-6%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	-1%	-2%
90%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	-2%	-2%	-3%
Long Term												
Full Simulation Period ^b	-2%	0%	1%	0%	0%	0%	0%	0%	0%	-1%	-1%	-1%
Water Year Types^c												
Wet (32%)	-1%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	-2%	-3%
Above Normal (16%)	-3%	0%	1%	1%	0%	0%	0%	0%	0%	-1%	-1%	-2%
Below Normal (13%)	-3%	-1%	1%	0%	0%	0%	0%	0%	-1%	-1%	-1%	-1%
Dry (24%)	-2%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	-1%
Critical (15%)	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Note: All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.

1 **5B.3.12. American River at Mouth Temperature**

Table 5B.3.12.1. American River at the Mouth, Monthly Temperature (above the confluence with the Sacramento River)

Alternative 3

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	67.9	58.5	52.2	49.0	51.6	59.0	65.8	71.1	75.8	75.9	77.5	74.3
20%	66.2	58.1	51.4	48.4	50.6	56.9	62.4	70.0	72.2	72.4	75.2	72.6
30%	65.7	57.7	50.9	47.8	49.7	55.1	61.0	68.3	71.1	71.5	73.1	71.3
40%	65.1	57.3	50.3	47.7	49.1	53.3	60.0	66.6	69.6	71.1	72.1	70.7
50%	64.7	57.0	50.0	47.2	48.4	52.6	58.6	64.6	68.1	70.3	71.5	69.8
60%	64.4	56.7	49.5	46.5	48.0	51.3	58.2	63.1	67.0	69.6	71.0	69.6
70%	64.0	56.5	48.8	46.2	47.3	50.9	56.5	61.8	66.3	69.3	70.4	69.3
80%	63.3	56.1	48.2	45.5	46.9	50.5	55.2	60.7	65.3	68.8	69.0	68.7
90%	62.1	55.9	47.4	45.1	46.5	49.8	54.2	58.4	63.9	68.3	68.3	67.6
Long Term												
Full Simulation Period ^b	64.8	57.1	49.9	47.1	48.9	53.4	59.3	65.1	69.0	71.5	72.2	70.7
Water Year Types^c												
Wet (32%)	61.5	54.6	47.5	46.2	47.2	50.8	55.9	61.1	65.5	70.1	69.4	68.8
Above Normal (16%)	65.3	57.2	49.9	47.1	48.0	51.3	57.9	64.6	68.3	68.9	71.4	69.7
Below Normal (13%)	63.9	56.5	50.4	47.5	48.6	54.3	61.3	66.7	70.2	69.7	72.7	71.1
Dry (24%)	65.1	57.3	50.1	47.5	49.8	55.0	60.7	67.2	70.5	72.1	73.5	71.5
Critical (15%)	66.3	57.8	50.0	47.9	52.2	57.9	64.2	69.4	73.6	77.8	76.4	73.9

Alternative 3_WA

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	67.9	58.5	52.2	49.0	51.5	59.0	65.9	71.5	76.2	76.4	77.9	75.4
20%	66.4	58.0	51.3	48.4	50.6	57.0	63.5	69.9	72.8	72.7	75.4	72.5
30%	65.7	57.7	50.8	47.8	49.8	55.1	61.0	68.5	71.1	71.6	73.3	71.4
40%	65.0	57.4	50.2	47.6	49.1	53.3	60.1	66.6	69.7	71.1	72.1	70.9
50%	64.8	57.0	49.9	47.1	48.4	52.6	58.7	64.7	68.1	70.7	71.6	69.9
60%	64.2	56.7	49.5	46.5	48.0	51.3	58.2	63.2	67.2	69.7	70.9	69.6
70%	64.0	56.5	48.7	46.2	47.3	50.9	56.5	61.8	66.3	69.3	70.5	69.3
80%	63.4	56.0	48.1	45.5	46.9	50.5	55.2	60.8	65.4	68.9	69.1	68.9
90%	62.1	55.5	47.3	45.1	46.5	49.8	54.2	58.4	64.0	68.3	68.4	67.7
Long Term												
Full Simulation Period ^b	64.8	57.0	49.8	47.1	48.9	53.4	59.4	65.2	69.1	71.5	72.3	70.8
Water Year Types^c												
Wet (32%)	61.5	54.6	47.4	46.1	47.2	50.8	55.9	61.1	65.5	70.2	69.5	68.9
Above Normal (16%)	65.3	57.2	49.9	47.1	48.0	51.3	57.9	64.6	68.4	68.9	71.5	69.7
Below Normal (13%)	63.8	56.3	50.3	47.5	48.6	54.3	61.4	66.7	70.5	69.8	72.7	71.0
Dry (24%)	65.1	57.2	50.0	47.5	49.8	55.0	60.8	67.4	70.8	72.3	73.7	71.7
Critical (15%)	66.3	57.8	49.9	47.9	52.2	57.9	64.3	69.5	73.8	77.8	76.8	74.2

Alternative 3_WA minus Alternative 3

Statistic	Monthly Temperature (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	1%	0%	1%	0%	1%
20%	0%	0%	0%	0%	0%	0%	2%	0%	1%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
90%	0%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Note: All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.

Table 5B.3.12.2. American River at the Mouth, Monthly Temperature (above the confluence with the Sacramento River)

Alternative 5

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	67.8	58.4	52.3	48.7	51.5	59.2	66.2	71.4	76.7	75.8	77.4	74.4
20%	66.4	58.0	51.4	48.3	50.7	57.0	62.9	70.3	73.1	72.2	75.4	72.5
30%	65.5	57.6	50.8	47.7	49.8	55.1	61.0	68.2	71.1	71.5	73.0	71.2
40%	65.0	57.3	50.4	47.5	49.3	53.3	60.0	66.8	69.6	70.8	72.1	70.3
50%	64.6	56.9	49.9	47.2	48.5	52.6	58.6	64.9	68.3	70.1	71.4	69.7
60%	64.3	56.7	49.0	46.5	47.9	51.4	58.1	63.3	67.7	69.6	71.0	69.0
70%	63.8	56.5	48.6	46.0	47.3	50.9	56.4	61.7	66.2	69.2	70.6	68.2
80%	63.5	56.1	48.0	45.5	46.9	50.4	55.2	60.7	65.4	68.9	70.0	67.3
90%	62.5	55.8	47.3	45.0	46.5	49.8	54.2	58.4	63.9	68.5	68.6	66.7
Long Term												
Full Simulation Period ^b	64.7	57.0	49.7	47.0	48.9	53.4	59.4	65.2	69.2	71.3	72.4	70.1
Water Year Types^c												
Wet (32%)	61.5	54.6	47.2	46.1	47.2	50.8	55.9	61.1	65.7	69.8	70.0	67.2
Above Normal (16%)	65.3	57.1	49.9	47.0	48.1	51.4	57.8	64.5	69.0	69.1	71.1	68.8
Below Normal (13%)	63.7	56.4	50.0	47.3	48.6	54.3	61.5	66.9	71.1	69.8	73.5	71.3
Dry (24%)	65.0	57.3	50.0	47.4	49.8	55.0	60.7	67.4	70.8	71.8	73.5	71.5
Critical (15%)	66.3	57.7	49.9	47.8	52.2	58.0	64.6	69.6	72.7	77.5	75.8	74.2

Alternative 5_WA

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	67.8	58.4	52.7	48.9	51.5	59.2	66.2	71.5	76.8	76.3	77.9	74.2
20%	66.0	57.9	51.7	48.3	50.9	57.2	63.1	70.1	73.1	72.3	75.8	72.8
30%	65.0	57.5	51.2	48.0	49.9	55.1	61.1	68.4	71.1	71.4	72.9	70.8
40%	64.5	57.0	50.5	47.6	49.2	53.3	60.1	66.8	69.7	70.5	71.9	69.9
50%	63.8	56.7	50.3	47.3	48.5	52.6	58.7	65.0	68.2	69.6	71.3	69.1
60%	63.3	56.6	49.2	46.5	48.0	51.5	58.2	63.3	67.7	69.2	70.6	68.2
70%	62.5	56.4	48.7	46.1	47.3	50.9	56.5	61.8	66.5	68.8	70.1	67.2
80%	61.4	56.1	47.9	45.5	46.9	50.5	55.2	60.8	65.4	68.4	69.6	66.3
90%	60.6	55.5	47.2	45.1	46.5	49.8	54.1	58.4	63.5	67.9	67.8	65.3
Long Term												
Full Simulation Period ^b	63.9	56.9	50.0	47.1	48.9	53.5	59.4	65.2	69.3	71.0	72.1	69.5
Water Year Types^c												
Wet (32%)	61.0	54.7	47.4	46.1	47.2	50.8	55.9	61.1	65.7	69.3	69.3	66.0
Above Normal (16%)	64.1	57.1	50.4	47.2	48.2	51.4	57.9	64.6	69.0	68.6	70.8	68.2
Below Normal (13%)	62.5	55.9	50.4	47.4	48.6	54.3	61.5	66.8	71.0	69.5	73.4	70.8
Dry (24%)	64.3	57.1	50.3	47.6	49.9	55.0	60.8	67.4	70.9	71.8	73.5	71.3
Critical (15%)	65.7	57.6	50.1	47.9	52.3	58.1	64.7	69.7	73.1	77.6	76.1	74.2

Alternative 5_WA minus Alternative 5

Statistic	Monthly Temperature (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	1%	0%	0%	0%	0%	0%	0%	1%	1%	0%
20%	-1%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	-1%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%
50%	-1%	0%	1%	0%	0%	0%	0%	0%	0%	-1%	0%	-1%
60%	-2%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	-1%	-1%
70%	-2%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	-1%	-1%
80%	-3%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	-1%	-1%
90%	-3%	-1%	0%	0%	0%	0%	0%	0%	-1%	-1%	-1%	-2%
Long Term												
Full Simulation Period ^b	-1%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	-1%
Water Year Types^c												
Wet (32%)	-1%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	-1%	-2%
Above Normal (16%)	-2%	0%	1%	0%	0%	0%	0%	0%	0%	-1%	0%	-1%
Below Normal (13%)	-2%	-1%	1%	0%	0%	0%	0%	0%	0%	0%	0%	-1%
Dry (24%)	-1%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Note: All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.

1 **5B.3.13. Temperature Threshold Exceedances -**
2 **American River**

Table 5B.3.13.1. Temperature Threshold Exceedances - American River

Species	Lifestage	River	Reach	Water Year Type	Month	Temperature Objective (Degree F)	Temperature Objective Reference ¹	Alternative 3	Alternative 5	Alternative 3_WA	Alternative 5_WA	Alternative 3_WA minus Alternative 3	Alternative 5_WA minus Alternative 5
Juvenile steelhead	Rearing	American	Watt Ave Bridge	All	May	65	BDCP 2013	33%	32%	33%	33%	-1%	1%
Juvenile steelhead	Rearing	American	Watt Ave Bridge	All	June	65	BDCP 2013	55%	56%	55%	57%	0%	2%
Juvenile steelhead	Rearing	American	Watt Ave Bridge	All	July	65	BDCP 2013	99%	99%	99%	99%	0%	0%
Juvenile steelhead	Rearing	American	Watt Ave Bridge	All	August	65	BDCP 2013	93%	94%	94%	94%	0%	0%
Juvenile steelhead	Rearing	American	Watt Ave Bridge	All	September	65	BDCP 2013	96%	90%	96%	91%	0%	1%
Juvenile steelhead	Rearing	American	Watt Ave Bridge	All	October	65	BDCP 2013	30%	28%	28%	27%	-2%	-1%

¹See section 9N.C for the full reference

1 **Appendix 5C**

2 **Revised Second Basis of Comparison**

3 A CalSim II model error was identified in New Melones operations in the Second
4 Basis of Comparison simulation. The model error is due to use of an incorrect
5 lookup table for one month and causes New Melones to release increased fishery
6 flows in May. This appendix provides findings from an analysis of potential
7 effects of this model error.

8 **5C.1 Methodology**

9 CalSim II model simulation representing the Second Basis of Comparison is rerun
10 with the corrected New Melones Operations. The results are analyzed in two
11 different sections. First, the Revised Second Basis of Comparison (SBC_R) is
12 compared against the Second Basis of Comparison (SBC) to identify the extent of
13 the effects of this model error. As presented in the next section, the results show
14 that the effects of this model error is contained within the Stanislaus River.
15 Secondly, the No Action Alternative (model results same as Alternative 2),
16 Alternative 3, and Alternative 5 are compared against the Revised Second Basis
17 of Comparison (SBC_R) and the Alternative 1 (same as Revised Second Basis of
18 Comparison (SBC_R) is compared against the No Action Alternative. Results
19 analysis in this appendix identifies between similar results (less than 5%) and
20 results with noticeable changes (greater than 5%).

21 **5C.2 Analysis**

22 **5C.2.1 Revised Second Basis of Comparison Compared to the** 23 **Second Basis of Comparison**

24 Model results comparing Revised Second Basis of Comparison (SBC_R) to the
25 Second Basis of Comparison (SBC) presented in Section 5C.3.1 of this document
26 show that the effect of the CalSim II model error is confined to Stanislaus River
27 basin and do not cause any significant change in the overall system operations.

28 **5C.2.2 Revised Second Basis of Comparison Compared to the** 29 **Alternatives**

30 This section provides analysis of effects of the identified CalSim II model error
31 on the Stanislaus River Basin. The section is organized by alternative comparison
32 and by each parameter that is likely to change.

33 The changes described in this section are due to increased storage in New
34 Melones and decrease and change in patter of flows in Stanislaus River
35 downstream of New Melones under the Revised Second Basis of Comparison
36 (Revised Alternative 1) compared to the Second Basis of Comparison
37 (Alternative 1).

1 **5C.2.2.1 Revised Alternative 1 Compared to the No Action Alternative**

2 **5C.2.2.1.1 New Melones Storage**

3 Alternative 1 showed increased storage in October and November of above
4 normal years (up to 6%), October and April of below normal years (slightly above
5 5%), October of dry years (slightly above 5%), and October through June of
6 critically dry years (up to 7%) when compared to the No Action Alternative.
7 Revised Alternative 1 shows increased storage in all months of all water year
8 types when compared to the No Action Alternative (from approximately 6 to
9 44%).

10 **5C.2.2.1.2 New Melones Elevation**

11 Alternative 1 showed similar elevation (within 5% change) in all months of all
12 water year types when compared to the No Action Alternative. Revised
13 Alternative 1 shows increased reservoir elevation in all months of all water year
14 types (from approximately 8 to 13%) when compared to the No Action
15 Alternative.

16 **5C.2.2.1.3 Stanislaus River Flow below Goodwin**

17 Flow patterns are different between the Second Basis of Comparison and the
18 Revised Second Basis of Comparison and the changes between alternatives reflect
19 the change in patterns.

- 20 • In wet years, Alternative 1 showed lower flows (from approximately 5 to
21 54%) in October, March, May, July, and August, higher flows (from
22 approximately 6 to 103%) in November, December, January, June, and
23 September), and similar flows (within 5% change) in February and April
24 when compared to the No Action Alternative.

25 Revised Alternative 1 shows lower flows (from approximately 8 to 57%) in
26 October, March, and May, higher flows (from approximately 12 to 59%) in
27 November, December, February, June, July, August, and September, and
28 similar flows (within 5% change) in January and April when compared to the
29 No Action Alternative.

- 30 • In above normal years, Alternative 1 showed lower flows (from
31 approximately 19 to 58%) in October, March, and April months, higher flows
32 (from approximately 7 to 54%) in November, December, January, February,
33 May, and June), and similar flows (within 5% change) in July through
34 September when compared to the No Action Alternative.

35 Revised Alternative 1 shows lower flows (from approximately 7 to 65%) in
36 October, March, April, and May, higher flows (from approximately 5 to 25%)
37 in November, December, and February, and similar flows (within 5% change)
38 in January and June through September when compared to the No Action
39 Alternative.

- 40 • In below normal years, Alternative 1 showed lower flows (from
41 approximately 14 to 61%) in October, March, and April months, higher flows

1 (from approximately 5 to 66%) in November through February, May, June,
 2 and September), and similar flows (within 5% change) in July and August
 3 when compared to the No Action Alternative.

4 Revised Alternative 1 shows lower flows (from approximately 13 to 66%) in
 5 October, March, April, May, and June, higher flows (from approximately
 6 19 to 54%) in November through February, and similar flows (within 5%
 7 change) in July through September when compared to the No Action
 8 Alternative.

- 9 • In dry years, Alternative 1 showed lower flows (approximately 61 and 44%)
 10 in October and April months, higher flows (from approximately 7 to 56%) in
 11 November through March, May, and June), and similar flows (within 5%
 12 change) in July through September when compared to the No Action
 13 Alternative.

14 Revised Alternative 1 shows lower flows (from approximately 7 to 65%) in
 15 October, March, April, May, and June, higher flows (from approximately 8 to
 16 36%) in November through February, and similar flows (within 5% change) in
 17 July through September when compared to the No Action Alternative.

- 18 • In critically dry years, Alternative 1 showed lower flows (approximately
 19 66 and 37%) in October and April months, higher flows (from approximately
 20 5 to 41%) in November through March, May, and July), and similar flows
 21 (within 5% change) in June, August, and September when compared to the No
 22 Action Alternative.

23 Revised Alternative 1 shows lower flows (from approximately 10 to 74%) in
 24 October, January, March, April, and May, higher flows (from approximately
 25 6 to 18%) in November, December, July, and August, and similar flows
 26 (within 5% change) in February, June, and September when compared to the
 27 No Action Alternative.

28 **5C.2.2.1.4 Stanislaus River Flow at Mouth**

- 29 • In wet years, Alternative 1 showed higher flows (from approximately 5 to
 30 81%) in November, December, January, and June, lower flows (from
 31 approximately 7 to 44%) in October, March, May, and August, and similar
 32 flows (within 5% change) in February, April, July, and September when
 33 compared to the No Action Alternative.

34 Revised Alternative 1 shows lower flows (from approximately 7 to 47%) in
 35 October, March, and May, higher flows (from approximately 11 to 46%) in
 36 November, December, February, June, July, August, and September, and
 37 similar flows (within 5% change) in January and April when compared to the
 38 No Action Alternative.

- 39 • In above normal years, Alternative 1 showed higher flows (from
 40 approximately 6 to 33%) in November through February, May, and June,
 41 lower flows (from approximately 15 to 46%) in October, March, and April,

1 and similar flows (within 5% change) in July through September when
2 compared to the No Action Alternative.

3 Revised Alternative 1 shows lower flows (from approximately 7 to 51%) in
4 October, March, April, and May, higher flows (from approximately 14 to
5 15%) in November and December, and similar flows (within 5% change) in
6 January, February, and June through September when compared to the No
7 Action Alternative.

8 • In below normal years, Alternative 1 showed higher flows (from
9 approximately 5 to 42%) in November through February and June, lower
10 flows (from approximately 9 to 49%) in October, March, and April, and
11 similar flows (within 5% change) in May, July, August, and September when
12 compared to the No Action Alternative.

13 Revised Alternative 1 shows lower flows (from approximately 9 to 52%) in
14 October and March through June, higher flows (from approximately 13 to
15 36%) in November through February, and similar flows (within 5% change) in
16 July through September when compared to the No Action Alternative.

17 • In dry years, Alternative 1 showed higher flows (approximately 14 and 38%)
18 in November through March and May, lower flows (approximately 47% and
19 42%) in October and April, and similar flows (within 5% change) in June
20 through September when compared to the No Action Alternative.

21 Revised Alternative 1 shows lower flows (from approximately 5 to 50%) in
22 October, April, May, and June, higher flows (from approximately 5 to 25%) in
23 November through February, and similar flows (within 5% change) in March
24 and July through September when compared to the No Action Alternative.

25 • In critically dry years, Alternative 1 showed higher flows (approximately
26 8 and 30%) in November through March and May, lower flows
27 (approximately 54% and 37%) in October and April, and similar flows (within
28 5% change) in June through September when compared to the No Action
29 Alternative.

30 Revised Alternative 1 shows lower flows (from approximately 7 to 60%) in
31 October, January, March, April, and May, higher flows (from approximately
32 7 to 14%) in November, December, and July, and similar flows (within 5%
33 change) in February, June, August, and September when compared to the No
34 Action Alternative.

35 **5C.2.2.1.5 Stanislaus River Water Temperature below Goodwin Dam**

36 Alternative 1 showed similar temperatures at Goodwin except for higher
37 temperatures in November of critically dry years (average increase of 0.7 °F) and
38 lower temperatures in June and September of critically dry years (up to 1.3 °F)
39 when compared to the No Action Alternative. Difference in temperature
40 threshold exceedances were all within 5% (varied from 2% less to 3% more
41 exceedances in January through May).

1 Revised Alternative 1 shows similar temperatures at Goodwin except for lower
 2 temperatures (from approximately 0.5 to 1.1 °F) in October and September of
 3 above normal years, August and September of dry years, and October, June, July,
 4 and September of critically dry years. Difference in temperature threshold
 5 exceedances are mostly within 5% (3% to 4% more in January through April) and
 6 5% more in May.

7 In general, Revised Alternative 1 shows higher temperatures for Steelhead smolts
 8 in Stanislaus when compared to the No Action Alternative.

9 **5C.2.2.1.6 Stanislaus River Water Temperature at Orange Blossom Bridge**

10 Alternative 1 showed similar temperatures at Orange Blossom Bridge except for
 11 higher temperatures in October of wet years, October and April of above normal,
 12 below normal, dry, and critically dry years (from approximately 0.6 to 1.9°F) and
 13 lower temperatures in June of wet years, March and June of below normal years,
 14 and May and July of critically dry years (approximately from 0.6 to 0.7°F) when
 15 compared to the No Action Alternative. Difference in temperature threshold
 16 exceedances showed 28% more exceedance in October (adult migration
 17 threshold), 6% more exceedance in April (smoltification threshold), 17% more
 18 exceedance in April (spawning threshold), 8% less exceedance in May
 19 (smoltification threshold), and 5% less in November (adult migration threshold)
 20 and March and May (spawning threshold).

21 Revised Alternative 1 shows similar temperatures at Orange Blossom Bridge
 22 except for higher temperatures (from approximately 0.5 to 2.1°F) in October and
 23 March of wet years, October and April of above normal years, October and June
 24 of below normal years, October, April, and May of dry years, and October,
 25 March, and April of critically dry years; and lower temperatures (from
 26 approximately 0.5 to 1.2°F) in September of wet years, August and September of
 27 dry years, and July, August, and September of critically dry years when compared
 28 to the No Action Alternative. Difference in temperature threshold exceedances
 29 showed 29% more exceedance in October (adult migration threshold), 10% more
 30 exceedance in March (smoltification threshold), 5% more exceedance in April
 31 (smoltification threshold), 14% more exceedance in March and April (spawning
 32 threshold), 9% more exceedance in May (spawning threshold), and 6% less in
 33 November (adult migration threshold) , 8% less in August (rearing threshold).

34 In general, Revised Alternative 1 shows higher temperatures for Steelhead
 35 lifestages in Stanislaus when compared to the No Action Alternative.

36 **5C.2.2.1.7 CVP Stanislaus Deliveries**

37 Under Alternative 1, annual CVP service contract deliveries were increased by
 38 4.5 TAF and annual water rights deliveries were increased by 2.3 TAF when
 39 compared to the No Action Alternative.

40 Under Revised Alternative 1, annual CVP service contract deliveries are
 41 increased by 14.8 TAF and annual water rights deliveries are increased by
 42 6.2 TAF when compared to the No Action Alternative.

1 In general, Revised Alternative 1 shows increased CVP Stanislaus deliveries
2 when compared to the No Action Alternative.

3 **5C.2.2.1.8 CVP Power Generation**

4 Long-term average power capacity and energy generation under Alternative 1
5 were 3% and 1% higher than the No Action Alternative. The energy use at the
6 CVP pumping facilities was 16% higher than the No Action Alternative; which
7 resulted in a 4% lower net generation.

8 In dry and critical years, long-term average power capacity and energy generation
9 under Alternative 1 were 6% and 3% higher than the No Action Alternative. The
10 energy use at the CVP pumping facilities was 11% higher than the No Action
11 Alternative; which resulted in similar net generation.

12 Under the revised Alternative 1, long-term average power capacity and energy
13 generation are 4% and 1% higher than the No Action Alternative. The energy use
14 at the CVP pumping facilities is 15% higher than the No Action Alternative;
15 which results in a 3% lower net generation.

16 In dry and critical years, long-term average power capacity and energy generation
17 under Revised Alternative 1 are 10% and 5% higher than the No Action
18 Alternative. The energy use at the CVP pumping facilities is 15% higher than the
19 No Action Alternative; which results 3% higher net generation.

20 **5C.2.2.1.9 New Melones Large Mouth Bass Nest Survival Percentage**

21 Monthly pattern of reservoir storage is different between the Second Basis of
22 Comparison and the Revised Second Basis of Comparison and the changes
23 between alternatives reflect the change in this pattern.

- 24 • In wet years, Alternative 1 showed lower percentage of nest survival in June
25 (approximately 13%), higher percentage of nest survival (48% and 11%) in
26 October and April when compared to the No Action Alternative.

27 The Revised Alternative 1 shows lower percentage of nest survival (from
28 approximately 7 to 14%) in July through September, higher percentage of nest
29 survival (approximately 49 and 10%) in October and April when compared to
30 the No Action Alternative.

- 31 • In above normal years, Alternative 1 showed lower percentage of nest survival
32 in June (approximately 5%), higher percentage of nest survival (29% and 9%)
33 in October and April when compared to the No Action Alternative.

34 The Revised Alternative 1 shows higher percentage of nest survival (from
35 approximately 6 to 31%) in October, April, July, and August when compared
36 to the No Action Alternative.

- 37 • In below normal years, Alternative 1 showed lower percentage of nest
38 survival (approximately 9%) in June; and higher percentage of nest survival
39 (from approximately 5% and 55%) in October, March, April, and July when
40 compared to the No Action Alternative.

- 1 The Revised Alternative 1 shows higher percentage of nest survival (from
 2 approximately 5 to 59%) in October and March through August when
 3 compared to the No Action Alternative.
- 4 • In dry years, Alternative 1 showed lower percentage of nest survival
 5 (approximately 9%) in May; and higher percentage of nest survival (from
 6 approximately 12% and 44%) in October, April, and July when compared to
 7 the No Action Alternative.
- 8 The Revised Alternative 1 shows higher percentage of nest survival (from
 9 approximately 7 to 51%) in October and April through September when
 10 compared to the No Action Alternative.
- 11 • In critically dry years, Alternative 1 showed lower percentage of nest survival
 12 (from approximately 12 to 23%) in May, July, and August; and higher
 13 percentage of nest survival (from approximately 7% and 53%) in October,
 14 April, and September when compared to the No Action Alternative.
- 15 The Revised Alternative 1 shows lower percentage of nest survival (from
 16 approximately 7 to 45%) in June through August; and higher percentage of
 17 nest survival (from approximately 34 to 53%) in October, April, and May
 18 when compared to the No Action Alternative.
- 19 In general, Revised Alternative 1 shows higher percentage of nest survival for the
 20 New Melones Large Mouth Bass when compared to the No Action Alternative.

21 **5C.2.2.1.10 New Melones Small Mouth Bass Nest Survival Percentage**

- 22 Monthly pattern of reservoir storage is different between the Second Basis of
 23 Comparison and the Revised Second Basis of Comparison and the changes
 24 between alternatives reflect the change in this pattern.
- 25 • In wet years, Alternative 1 showed lower percentage of nest survival in June
 26 (approximately 15%), higher percentage of nest survival (59% and 9%) in
 27 October and April when compared to the No Action Alternative.
- 28 The Revised Alternative 1 shows lower percentage of nest survival (from
 29 approximately 6 to 14%) in July through September, higher percentage of nest
 30 survival (approximately 61 and 9%) in October and April when compared to
 31 the No Action Alternative.
- 32 • In above normal years, Alternative 1 showed higher percentage of nest
 33 survival (41% and 10%) in October and April when compared to the No
 34 Action Alternative.
- 35 The Revised Alternative 1 shows higher percentage of nest survival (from
 36 approximately 8 to 44%) in October, April, July, and August when compared
 37 to the No Action Alternative.
- 38 • In below normal years, Alternative 1 showed lower percentage of nest
 39 survival (approximately 10 and 14%) in June and July; and higher percentage
 40 of nest survival (from approximately 6% to 57%) in October, March, and
 41 April when compared to the No Action Alternative.

1 The Revised Alternative 1 shows higher percentage of nest survival (from
2 approximately 5 to 61%) in October and March through August when
3 compared to the No Action Alternative.

- 4 • In dry years, Alternative 1 showed lower percentage of nest survival
5 (approximately 8% and 5%) in May and November; and higher percentage of
6 nest survival (from approximately 11% to 52%) in October, April, and July
7 when compared to the No Action Alternative.

8 The Revised Alternative 1 shows higher percentage of nest survival (from
9 approximately 6 to 59%) in October and April through September when
10 compared to the No Action Alternative.

- 11 • In critically dry years, Alternative 1 showed lower percentage of nest survival
12 (from approximately 5 to 22%) in November, May, July, and August; and
13 higher percentage of nest survival (from approximately 6% to 58%) in
14 October, April, and September when compared to the No Action Alternative.

15 The Revised Alternative 1 shows lower percentage of nest survival (from
16 approximately 7 to 50%) in June through September; and higher percentage of
17 nest survival (from approximately 44 to 69%) in October, and April when
18 compared to the No Action Alternative.

19 In general, Revised Alternative 1 shows higher percentage of nest survival for the
20 New Melones Small Mouth Bass when compared to the No Action
21 Alternative except for the summer months of critically dry years.

22 **5C.2.2.1.11 New Melones Spotted Bass Nest Survival Percentage**

23 Monthly pattern of reservoir storage is different between the Second Basis of
24 Comparison and the Revised Second Basis of Comparison and the changes
25 between alternatives reflect the change in this pattern.

- 26 • In wet years, Alternative 1 showed higher percentage of nest survival (from
27 approximately 6% to 13%) in October, April, July and August when
28 compared to the No Action Alternative.

29 The Revised Alternative 1 shows higher percentage of nest survival (from
30 approximately 11% to 13%) in October, April, and July when compared to the
31 No Action Alternative.

- 32 • In above normal years, Alternative 1 showed similar percentage of nest
33 survival when compared to the No Action Alternative.

34 The Revised Alternative 1 shows higher percentage of nest survival (from
35 approximately 6% to 8%) in July and August when compared to the No
36 Action Alternative.

- 37 • In below normal years, Alternative 1 showed higher percentage of nest
38 survival (from approximately 5% to 11%) in October, April, and July when
39 compared to the No Action Alternative.

1 The Revised Alternative 1 shows higher percentage of nest survival (from
2 approximately 6 to 10%) in October, April, and August when compared to the
3 No Action Alternative.

- 4 • In dry years, Alternative 1 showed lower percentage of nest survival
5 (approximately 5%) in May when compared to the No Action Alternative.

6 The Revised Alternative 1 shows higher percentage of nest survival (from
7 approximately 5% to 13%) in May, July and August when compared to the No
8 Action Alternative.

- 9 • In critically dry years, Alternative 1 showed lower percentage of nest survival
10 (from approximately 10% to 17%) in May and July; and higher percentage of
11 nest survival (approximately 20% to 9%) in April and June when compared to
12 the No Action Alternative.

13 The Revised Alternative 1 shows lower percentage of nest survival
14 (approximately 7%) in July; and higher percentage of nest survival (from
15 approximately 5% to 21%) in April through June, and September when
16 compared to the No Action Alternative.

17 In general, Revised Alternative 1 shows higher percentage of nest survival for the
18 New Melones Spotted Bass when compared to the No Action Alternative.

19 **5C.2.2.2 No Action Alternative Compared to the Revised Second Basis of** 20 **Comparison**

21 **5C.2.2.2.1 New Melones Storage**

22 No Action Alternative showed decreased storage in October and November of
23 above normal years (up to 6%), October and April of below normal years (slightly
24 above 5%), October of dry years (slightly above 5%), and October through June
25 of critically dry years (up to 7%) when compared to the Second Basis of
26 Comparison. When compared to the Revised Second Basis of Comparison, the
27 No Action Alternative shows decreased storage (from approximately 6 to 44%) in
28 all months of all water year types.

29 **5C.2.2.2.2 New Melones Elevation**

30 No Action Alternative showed similar reservoir elevation (within 5% change) in
31 all months of all water year types when compared to the Second Basis of
32 Comparison. When compared to the Revised Second Basis of Comparison, the
33 No Action Alternative shows decreased reservoir elevation in all months of all
34 water year types (from approximately 8 to 13%).

35 **5C.2.2.2.3 Stanislaus River Flow below Goodwin**

36 Flow patterns are different between the Second Basis of Comparison and the
37 Revised Second Basis of Comparison and the changes between alternatives reflect
38 the change in patterns.

- 39 • In wet years, the No Action Alternative showed lower flows (from
40 approximately 5 to 51%) in November, December, January, June, and

- 1 September months, higher flows (from approximately 10 to 117%) in October,
2 March, May, July, and August, and similar flows (within 5% change) in
3 February and April when compared to the Second Basis of Comparison.
- 4 When compared to the Revised Second Basis of Comparison, the No Action
5 Alternative shows lower flows (from approximately 11 to 37%) in November,
6 December, February, June, July, August, and September, higher flows (from
7 approximately 9 to 134%) in October, March, and May, and similar flows
8 (within 5% change) in January and April when compared to the No Action
9 Alternative.
- 10 • In above normal years, the No Action Alternative showed lower flows (from
11 approximately 6 to 35%) in November, December, January, February, May,
12 and June months, higher flows (from approximately 23 to 137%) in October,
13 March, and April, and similar flows (within 5% change) in July through
14 September when compared to the Second Basis of Comparison.
- 15 When compared to the Revised Second Basis of Comparison, the No Action
16 Alternative shows lower flows (from approximately 5 to 20%) in November,
17 December, and February, higher flows (from approximately 8 to 188%) in
18 October, March, April, and May, and similar flows (within 5% change) in
19 January and June through September when compared to the No Action
20 Alternative.
- 21 • In below normal years, the No Action Alternative showed lower flows (from
22 approximately 5 to 40%) in November through February, May, June, and
23 September) months, higher flows (from approximately 16 to 157%) in
24 October, March, and April, and similar flows (within 5% change) in July and
25 August when compared to the Second Basis of Comparison.
- 26 When compared to the Revised Second Basis of Comparison, the No Action
27 Alternative shows lower flows (from approximately 16 to 35%) in November
28 through February, higher flows (from approximately 15 to 192%) in October,
29 March, April, May, and June, and similar flows (within 5% change) in July
30 through September.
- 31 • In dry years, the No Action Alternative showed lower flows (approximately
32 6 to 36%) in November through March, May, and June, higher flows (from
33 approximately 154 and 77%) in October and April months, and similar flows
34 (within 5% change) in July through September when compared to the Second
35 Basis of Comparison.
- 36 When compared to the Revised Second Basis of Comparison, the No Action
37 Alternative shows lower flows (from approximately 8 to 26%) in November
38 through February, higher flows (from approximately 8 to 189%) in October,
39 March, April, May, and June, and similar flows (within 5% change) in July
40 through September.
- 41 • In critically dry years, the No Action Alternative showed lower flows
42 (approximately 9 to 29%) in November through March, and May, higher
43 flows (approximately 197 and 60%) in October and April months, and similar

1 flows (within 5% change) in June through September when compared to the
2 Second Basis of Comparison.

3 When compared to the Revised Second Basis of Comparison, the No Action
4 Alternative shows lower flows (from approximately 6 to 15%) in November,
5 December, July, and August, higher flows (from approximately 12 to 277%)
6 in October, January, March, April, and May, and similar flows (within 5%
7 change) in February, June, and September.

8 **5C.2.2.2.4 Stanislaus River Flow at Mouth**

9 Flow patterns are different between the Second Basis of Comparison and the
10 Revised Second Basis of Comparison and the changes between alternatives reflect
11 the change in patterns.

12 • In wet years, No Action Alternative showed lower flows (from approximately
13 5 to 45%) in November, December, January, and June, higher flows (from
14 approximately 8 to 79%) in October, March, May, and August, and similar
15 flows (within 5% change) in February, April, July, and September when
16 compared to the Second Basis of Comparison.

17 When compared to the Revised Second Basis of Comparison, No Action
18 Alternative shows lower flows (from approximately 10 to 32%) in November,
19 December, February, and June through September, higher flows (from
20 approximately 8 to 88%) in October, March, and May, and similar flows
21 (within 5% change) in January and April when compared to No Action
22 Alternative.

23 • In above normal years, No Action Alternative showed lower flows (from
24 approximately 6 to 25%) in November through February and May and June,
25 higher flows (from approximately 18 to 84%) in October, March, and April,
26 and similar flows (within 5% change) in July, August, and September when
27 compared to the Second Basis of Comparison.

28 When compared to the Revised Second Basis of Comparison, No Action
29 Alternative shows lower flows (approximately 13 and 12%) in November and
30 December, higher flows (from approximately 7 to 106%) in October, March,
31 April, and May, and similar flows (within 5% change) in January, February,
32 and June through September when compared to the No Action Alternative.

33 • In below normal years, No Action Alternative showed lower flows (from
34 approximately 12 to 29%) in November through February and June, higher
35 flows (from approximately 10 to 94%) in October, March, and April, and
36 similar flows (within 5% change) in May, and July through September when
37 compared to the Second Basis of Comparison.

38 When compared to the Revised Second Basis of Comparison, No Action
39 Alternative shows lower flows (from approximately 11 to 26%) in November
40 through February, higher flows (from approximately 10 to 109%) in October
41 and March through June, and similar flows (within 5% change) in July
42 through September.

1 • In dry years, No Action Alternative showed lower flows (approximately 5 to
2 28%) in, November through March and May and June, higher flows
3 (approximately 88% and 73%) in October and April, and similar flows (within
4 5% change) in June through September when compared to the Second Basis
5 of Comparison.

6 When compared to the Revised Second Basis of Comparison, No Action
7 Alternative shows lower flows (approximately 5 to 20%) in November
8 through February, higher flows (from approximately 6 to 102%) in October,
9 April, May, and June, and similar flows (within 5% change) in March and
10 July through September.

11 • In critically dry years, No Action Alternative showed lower flows
12 (approximately 7 to 23%) in November through March, and May, higher
13 flows (approximately 118 and 58%) in October and April and similar flows
14 (within 5% change) in June through September when compared to the Second
15 Basis of Comparison.

16 When compared to the Revised Second Basis of Comparison, No Action
17 Alternative shows lower flows (from approximately 6 to 12%) in November,
18 December, and July, higher flows (from approximately 27 to 149%) in
19 October, January, March, April, May, and July, and similar flows (within 5%
20 change) in February, June, August, and September.

21 **5C.2.2.2.5 Stanislaus River Water Temperature below Goodwin Dam**

22 No Action Alternative showed similar temperatures at Goodwin except for higher
23 temperatures in June and September critically dry years (average increase of 0.8
24 and 1.3°F) and lower temperatures in November of critically dry years (up to
25 0.7°F) when compared to the Second Basis of Comparison. Difference in
26 temperature threshold exceedances were all within 5% (varied from 3% less to
27 2% more exceedances in January through May).

28 No Action Alternative shows similar temperatures at Goodwin except for higher
29 temperatures (from approximately 0.5 to 1.1 °F) in October and September of
30 above normal years, August and September of dry years, and October, June, July,
31 and September of critically dry years when compared to the Revised Second Basis
32 of Comparison. Difference in temperature threshold exceedances are mostly
33 within 5% (2% to 4% less in January through April) and 5% less in May.

34 In general, No Action Alternative shows lower temperatures for Steelhead smolts
35 in Stanislaus when compared to the Revised Second Basis of Comparison.

36 **5C.2.2.2.6 Stanislaus River Water Temperature at Orange Blossom Bridge**

37 No Action Alternative showed similar temperatures at Orange Blossom Bridge
38 except for lower temperatures in October of wet years, October and April of
39 above normal, below normal, dry, and critically dry years (from approximately
40 0.6 to 1.9°F) and higher temperatures in June of wet years, March and June of
41 below normal years, and May and July of critically dry years (approximately from
42 0.6 to 0.7°F) when compared to the Second Basis of Comparison. Difference in

1 temperature threshold exceedances showed 28% less exceedance in October
 2 (adult migration threshold), 6% less exceedance in April (smoltification
 3 threshold), 17% less exceedance in April (spawning threshold), 8% more
 4 exceedance in May (smoltification threshold), and 5% more in November (adult
 5 migration threshold) and March and May (spawning threshold).

6 No Action Alternative shows similar temperatures at Orange Blossom Bridge
 7 except for lower temperatures (from approximately 0.5 to 2.1°F) in October and
 8 March of wet years, October and April of above normal years, October and June
 9 of below normal years, October, April, and May of dry years, and October,
 10 March, and April of critically dry years; and higher temperatures (from
 11 approximately 0.5 to 1.2°F) in September of wet years, August and September of
 12 dry years, and July, August, and September of critically dry years when compared
 13 to the Revised Second Basis of Comparison. Difference in temperature threshold
 14 exceedances showed 29% less exceedance in October (adult migration threshold),
 15 10% less exceedance in March (smoltification threshold), 5% less exceedance in
 16 April (smoltification threshold), 14% less exceedance in March and April
 17 (spawning threshold), 9% less exceedance in May (spawning threshold), and 6%
 18 more in November (adult migration threshold), 8% more in August (rearing
 19 threshold).

20 In general, No Action Alternative shows lower temperatures for Steelhead
 21 lifestages in Stanislaus when compared to the Revised Second Basis of
 22 Comparison.

23 **5C.2.2.2.7 CVP Stanislaus Deliveries**

24 Under the No Action Alternative, annual CVP service contract deliveries were
 25 decreased by 4.5 TAF and annual water rights deliveries were decreased by
 26 2.3 TAF when compared to the Second Basis of Comparison.

27 When compared to the Revised Second Basis of Comparison, annual CVP service
 28 contract deliveries are decreased by 14.8 TAF and annual water rights deliveries
 29 are decreased by 6.2 TAF under the No Action Alternative.

30 In general, the No Action Alternative shows decreased CVP Stanislaus deliveries
 31 when compared to the Revised Second Basis of Comparison.

32 **5C.2.2.2.8 CVP Power Generation**

33 Long-term average power capacity and energy generation under the No Action
 34 Alternative were 3% and 1% lower than the Second Basis of Comparison. The
 35 energy use at the CVP pumping facilities was 14% lower than the Second Basis of
 36 Comparison; which resulted in a 4% higher net generation.

37 In dry and critical years, long-term average power capacity and energy generation
 38 under the No Action Alternative were 6% and 3% lower than the Second Basis of
 39 Comparison. The energy use at the CVP pumping facilities was 10% lower than
 40 the Second Basis of Comparison; which resulted in similar net generation.

41 When compares to the Revised Second Basis of Comparison, long-term average
 42 power capacity and energy generation are 4% and 1% lower under the No Action

1 Alternative. The energy use at the CVP pumping facilities is 13% lower than the
2 Revised Second Basis of Comparison; which results in a 3% higher net
3 generation.

4 In dry and critical years, long-term average power capacity and energy generation
5 under the No Action Alternative are 9% and 4% lower than the Revised Second
6 Basis of Comparison. The energy use at the CVP pumping facilities is 9% lower
7 than the Revised Second Basis of Comparison; which results 3% lower net
8 generation.

9 **5C.2.2.2.9 New Melones Large Mouth Bass Nest Survival Percentage**

10 Monthly pattern of reservoir storage is different between the Second Basis of
11 Comparison and the Revised Second Basis of Comparison and the changes
12 between alternatives reflect the change in this pattern.

- 13 • In wet years, the No Action Alternative showed higher percentage of nest
14 survival in June (approximately 16%); and lower percentage of nest survival
15 (32% and 10%) in October and April when compared to the Second Basis of
16 Comparison.

17 When compared to the Revised Second Basis of Comparison, the No Action
18 Alternative shows higher percentage of nest survival (from approximately 8 to
19 16%) in July through September; and lower percentage of nest survival
20 (approximately 33 and 9%) in October and April.

- 21 • In above normal years, the No Action Alternative showed higher percentage
22 of nest survival in June (approximately 5%); and lower percentage of nest
23 survival (22% and 8%) in October and April when compared to the Second
24 Basis of Comparison.

25 When compared to the Revised Second Basis of Comparison, the No Action
26 Alternative shows lower percentage of nest survival (from approximately 6 to
27 23%) in October, April, July, and August.

- 28 • In below normal years, the No Action Alternative showed higher percentage
29 of nest survival (approximately 10%) in June; and lower percentage of nest
30 survival (from approximately 5% and 35%) in October, March, April, and
31 July when compared to the Second Basis of Comparison.

32 When compared to the Revised Second Basis of Comparison, the No Action
33 Alternative shows lower percentage of nest survival (from approximately 5 to
34 37%) in October and March through August.

- 35 • In dry years, the No Action Alternative showed higher percentage of nest
36 survival (approximately 10%) in May; and lower percentage of nest survival
37 (from approximately 11% and 31%) in October, April, May, July and August
38 when compared to the Second Basis of Comparison.

39 When compared to the Revised Second Basis of Comparison, the No Action
40 Alternative shows lower percentage of nest survival (from approximately 7 to
41 34%) in October and April through September.

1 • In critically dry years, the No Action Alternative showed higher percentage of
2 nest survival (from approximately 13 to 30%) in May, July, and August; and
3 lower percentage of nest survival (from approximately 6% and 35%) in
4 October, April, and September when compared to the Second Basis of
5 Comparison.

6 When compared to the Revised Second Basis of Comparison, the No Action
7 Alternative shows higher percentage of nest survival (from approximately 7 to
8 81%) in June through August; and lower percentage of nest survival (from
9 approximately 25 to 35%) in October, April, and May.

10 In general, the No Action Alternative shows lower percentage of nest survival for
11 the New Melones Large Mouth Bass when compared to the Revised Second Basis
12 of Comparison.

13 **5C.2.2.2.10 New Melones Small Mouth Bass Nest Survival Percentage**

14 Monthly pattern of reservoir storage is different between the Second Basis of
15 Comparison and the Revised Second Basis of Comparison and the changes
16 between alternatives reflect the change in this pattern.

17 • In wet years, the No Action Alternative showed higher percentage of nest
18 survival in June (approximately 17%); and lower percentage of nest survival
19 (37% and 9%) in October and April when compared to the Second Basis of
20 Comparison.

21 When compared to the Revised Second Basis of Comparison, the No Action
22 Alternative shows higher percentage of nest survival (from approximately 8 to
23 16%) in July through September; and lower percentage of nest survival
24 (approximately 38 and 8%) in October and April.

25 • In above normal years, the No Action Alternative showed lower percentage of
26 nest survival (29% and 9%) in October and April when compared to the
27 Second Basis of Comparison.

28 When compared to the Revised Second Basis of Comparison, the No Action
29 Alternative shows lower percentage of nest survival (from approximately 7 to
30 30%) in October, April, July, and August.

31 • In below normal years, the No Action Alternative showed higher percentage
32 of nest survival (approximately 11%) in June; and lower percentage of nest
33 survival (from approximately 6% to 37%) in October, March, April, and July
34 when compared to the Second Basis of Comparison.

35 When compared to the Revised Second Basis of Comparison, the No Action
36 Alternative shows lower percentage of nest survival (from approximately 6 to
37 38%) in October, March through May, July, and August.

38 • In dry years, the No Action Alternative showed higher percentage of nest
39 survival (approximately 5% and 8%) in November and May; and lower
40 percentage of nest survival (from approximately 10% to 34%) in October,
41 April, and July when compared to the Second Basis of Comparison.

1 When compared to the Revised Second Basis of Comparison, the No Action
2 Alternative shows lower percentage of nest survival (from approximately 6 to
3 37%) in October and April through.

- 4 • In critically dry years, the No Action Alternative showed higher percentage of
5 nest survival (from approximately 5 to 28%) in November, May, July, and
6 August; and lower percentage of nest survival (from approximately 6% to
7 37%) in October, April, and September when compared to the Second Basis
8 of Comparison.

9 When compared to the Revised Second Basis of Comparison, the No Action
10 Alternative shows higher percentage of nest survival (from approximately 8 to
11 100%) in June through September; and lower percentage of nest survival
12 (from approximately 23 to 41%) in October, April, and May.

13 In general, the No Action Alternative shows lower percentage of nest survival for
14 the New Melones Small Mouth Bass when compared to the Revised Second Basis
15 of Comparison except for the summer months of critically dry years.

16 **5C.2.2.2.11 New Melones Spotted Bass Nest Survival Percentage**

17 Monthly pattern of reservoir storage is different between the Second Basis of
18 Comparison and the Revised Second Basis of Comparison and the changes
19 between alternatives reflect the change in this pattern.

- 20 • In wet years, the No Action Alternative showed lower percentage of nest
21 survival (from approximately 5% to 12%) in October, April, July, and August
22 when compared to the Second Basis of Comparison.

23 When compared to the Revised Second Basis of Comparison, the No Action
24 Alternative shows lower percentage of nest survival (from approximately 10%
25 to 12%) in October, April, and July.

- 26 • In above normal years, the No Action Alternative showed similar percentage
27 of nest survival when compared to the Second Basis of Comparison.

28 When compared to the Revised Second Basis of Comparison, the No Action
29 Alternative shows lower percentage of nest survival (from approximately 5 to
30 7%) in July and August.

- 31 • In below normal years, the No Action Alternative showed lower percentage of
32 nest survival (from approximately 5% to 10%) in October, April, and July
33 when compared to the Second Basis of Comparison.

34 When compared to the Revised Second Basis of Comparison, the No Action
35 Alternative shows lower percentage of nest survival (from approximately 5 to
36 9%) in October, April, and August.

- 37 • In dry years, the No Action Alternative showed higher percentage of nest
38 survival (approximately 5%) in May when compared to the Second Basis of
39 Comparison.

1 When compared to the Revised Second Basis of Comparison, the No Action
 2 Alternative shows lower percentage of nest survival (from approximately 8%
 3 to 12%) in July and August.

- 4 • In critically dry years, the No Action Alternative showed higher percentage of
 5 nest survival (from approximately 11% to 21%) in May and July; and lower
 6 percentage of nest survival (from approximately 8% to 17%) in April and June
 7 when compared to the Second Basis of Comparison.

8 When compared to the Revised Second Basis of Comparison, the No Action
 9 Alternative shows higher percentage of nest survival (from approximately 5%
 10 to 8%) in July and August; and lower percentage of nest survival (from
 11 approximately 5% to 18%) in April through June, and September.

12 In general, the No Action Alternative shows lower percentage of nest survival for
 13 the New Melones Spotted Bass when compared to the Revised Second Basis of
 14 Comparison.

15 **5C.2.2.3 Alternative 3 Compared to the Revised Second Basis of** 16 **Comparison**

17 **5C.2.2.3.1 New Melones Storage**

18 Alternative 3 showed increased storage (from approximately 8 to 32%) almost all
 19 months of all water year types except for February through May of wet years (less
 20 than 5% increase). When compared to the Revised Second Basis of Comparison,
 21 Alternative 3 shows similar storage in all months of all water year types (changes
 22 within 5%).

23 **5C.2.2.3.2 New Melones Elevation**

24 Alternative 3 showed similar reservoir elevation in all months of all water year
 25 types (changes within 5%). When compared to the Revised Second Basis of
 26 Comparison, Alternative 3 still shows similar reservoir elevation in all months of
 27 all water year types (changes within 5%).

28 **5C.2.2.3.3 Stanislaus River Flow below Goodwin**

29 Flow patterns are different between the Second Basis of Comparison and the
 30 Revised Second Basis of Comparison and the changes between alternatives reflect
 31 the change in patterns.

- 32 • In wet years, Alternative 3 showed lower flows (from approximately 40 to
 33 45%) in May and June, higher flows (from approximately 9 to 67%) in
 34 December, February, March, July, August, and September, and similar flows
 35 (within 5% change) in October, November, January, and April when
 36 compared to the Second Basis of Comparison.

37 When compared to the Revised Second Basis of Comparison, Alternative 3
 38 shows lower flows (from approximately 17 to 30%) in May and June, higher
 39 flows (from approximately 5 to 19%) in October, December, February, and

- 1 July, and similar flows (within 5% change) in November, January, March,
2 April, August, and September when compared to Alternative 3.
- 3 • In above normal years, Alternative 3 showed lower flows (from
4 approximately 14 to 79%) in November, May, June, and July months, higher
5 flows (from approximately 5 to 23%) in October, March, and April, and
6 similar flows (within 5% change) in December, January, February, August,
7 and September when compared to the Second Basis of Comparison.
- 8 When compared to the Revised Second Basis of Comparison, Alternative 3
9 shows lower flows (from approximately 10 to 74%) in May through July,
10 higher flows (from approximately 6 to 30%) in October through January,
11 March, and April, and similar flows (within 5% change) in February, August,
12 and September when compared to Alternative 3.
- 13 • In below normal years, Alternative 3 showed lower flows (from
14 approximately 7 to 58%) in October, November, December, March, May,
15 June, and September, higher flows (from approximately 18 to 32%) in
16 January, February, and April, and similar flows (within 5% change) in August
17 and September when compared to the Second Basis of Comparison.
- 18 When compared to the Revised Second Basis of Comparison, Alternative 3
19 shows lower flows (from approximately 7 to 38%) in November, December,
20 March, May, and June, higher flows (from approximately 6 to 44%) in
21 October and January, and similar flows (within 5% change) in February,
22 April, July, August, and September.
- 23 • In dry years, Alternative 3 showed lower flows (approximately 5 to 36%) in,
24 November through March, May, and June, higher flows (approximately 40%)
25 in April, and similar flows (within 5% change) in October and July through
26 September when compared to the Second Basis of Comparison.
- 27 When compared to the Revised Second Basis of Comparison, Alternative 3
28 shows lower flows (approximately 26%) in June, higher flows (from
29 approximately 8 to 19%) in October, March, and April, and similar flows
30 (within 5% change) in November through February, May, and July through
31 September.
- 32 • In critically dry years, Alternative 3 showed lower flows (approximately 8 to
33 31%) in November through March and May through July, higher flows
34 (approximately 5 to 47%) in October, April, and September, and similar flows
35 (within 5% change) in August when compared to the Second Basis of
36 Comparison.
- 37 When compared to the Revised Second Basis of Comparison, Alternative 3
38 shows lower flows (from approximately 6 to 19%) in January, February, June,
39 and July, higher flows (from approximately 9 to 36%) in October, November,
40 December, March, April, and May, and similar flows (within 5% change) in
41 August and September.

1 **5C.2.2.3.4 Stanislaus River Flow at Mouth**

2 • In wet years, Alternative 3 showed lower flows (from approximately 12 to
3 39%) in May and June, higher flows (from approximately 8 to 58%) in
4 December, February, March, July, August, and September, and similar flows
5 (within 5% change) in October, November, January, and April when
6 compared to the Second Basis of Comparison.

7 When compared to the Revised Second Basis of Comparison, Alternative 3
8 shows lower flows (from approximately 15 to 25%) in May and June, higher
9 flows (from approximately 6 to 17%) in October, December, February, and
10 July, and similar flows (within 5% change) in November, January, March,
11 April, August, and September when compared to Alternative 3.

12 • In above normal years, Alternative 3 showed lower flows (from
13 approximately 10 to 63%) in November, May, June, and July, higher flows
14 (approximately 19%) in April, and similar flows (within 5% change) in
15 October, December, January, February, March, August, and September when
16 compared to the Second Basis of Comparison.

17 When compared to the Revised Second Basis of Comparison, Alternative 3
18 shows lower flows (from approximately 9 to 57%) in May through July,
19 higher flows (from approximately 8 to 17%) in October, December, March,
20 and April, and similar flows (within 5% change) in November, February,
21 August, and September when compared to Alternative 3.

22 • In below normal years, Alternative 3 showed lower flows (from
23 approximately 9 to 44%) in November, December, March, May, June, and
24 September, higher flows (from approximately 16 to 23%) in January,
25 February, and April, and similar flows (within 5% change) in July, August,
26 and September when compared to the Second Basis of Comparison.

27 When compared to the Revised Second Basis of Comparison, Alternative 3
28 shows lower flows (from approximately 7 to 26%) in November, December,
29 May, and June, higher flows (approximately 30%) in January, and similar
30 flows (within 5% change) in October, February, March, April, July, August,
31 and September.

32 • In dry years, Alternative 3 showed lower flows (approximately 9 to 26%) in,
33 November December, January, March, May, and June, higher flows
34 (approximately 38%) in April, and similar flows (within 5% change) in
35 October, February, and July through September when compared to the Second
36 Basis of Comparison.

37 When compared to the Revised Second Basis of Comparison, Alternative 3
38 shows lower flows (approximately 18%) in June, higher flows (from
39 approximately 9 to 18%) in October and April, and similar flows (within 5%
40 change) in November through March, May, and July through September.

41 • In critically dry years, Alternative 3 showed lower flows (approximately 6 to
42 28%) in November through March and May through July, higher flows

1 (approximately 45%) in April, and similar flows (within 5% change) in
2 October, August, and September when compared to the Second Basis of
3 Comparison.

4 When compared to the Revised Second Basis of Comparison, Alternative 3
5 shows lower flows (from approximately 10 to 15%) in February, June, and
6 July, higher flows (from approximately 6 to 32%) in October, November,
7 December, March, April, and May, and similar flows (within 5% change) in
8 January, August, and September.

9 **5C.2.2.3.5 Stanislaus River Water Temperature below Goodwin Dam**

10 Alternative 3 showed similar temperatures at Goodwin except for lower
11 temperatures in October of above normal years, October and November of below
12 normal years, September of dry years, and October, November, May, and July
13 through September of critically dry years (varied from 0.5 to 1.5°F) when
14 compared to the Second Basis of Comparison. Difference in temperature
15 threshold exceedances were all within 5% (varied from 3% less to 3% more
16 exceedances in March through May).

17 Alternative 3 shows similar temperatures at Goodwin except for higher
18 temperatures in June (approximately 0.6°F) and lower temperatures in September
19 (approximately 0.6°F) of critically dry years when compared to the Revised
20 Second Basis of Comparison. Difference in temperature threshold exceedances
21 are mostly within 5% (1% to 4% less in January, February, and April) and 5%
22 less in May.

23 In general, Alternative 3 shows lower temperatures for Steelhead smolts in
24 Stanislaus when compared to the Revised Second Basis of Comparison.

25 **5C.2.2.3.6 Stanislaus River Water Temperature at Orange Blossom Bridge**

26 Alternative 3 showed similar temperatures at Orange Blossom Bridge except for
27 higher temperatures in June of wet years, May through July of above normal,
28 March and June of below normal years, March, May, and June of dry years, and
29 February and June of critically dry years (from approximately 0.5 to 4.3°F) and
30 lower temperatures in August wet years, April of below normal and dry years, and
31 October, November, April, August, and September of critically dry years
32 (approximately from 0.5 to 1.2°F) when compared to the Second Basis of
33 Comparison. Difference in temperature threshold exceedances showed 16% less
34 exceedance in April (spawning threshold), 7% more exceedance in May
35 (smoltification threshold), and 8% more in March (spawning threshold) and 10%
36 more in May (spawning threshold).

37 Alternative 3 showed similar temperatures at Orange Blossom Bridge except for
38 higher temperatures in June of wet years, June and July of above normal, June of
39 below normal and dry years, and June and July of critically dry years (from
40 approximately 0.6 to 5.1°F) and lower temperatures in October of wet and above
41 normal years, October and April of dry years, and October, March, April, and
42 September of critically dry years (approximately from 0.5 to 1.2°F) when
43 compared to the Revised Second Basis of Comparison. Difference in temperature

1 threshold exceedances showed 10% less exceedance in March (smoltification
 2 threshold), 5% less exceedance in May (smoltification threshold), 11 and 12%
 3 less in March and April (spawning threshold), and 5% more exceedance in July
 4 (rearing threshold).

5 In general, Alternative 3 shows lower temperatures for Steelhead lifestages in
 6 Stanislaus when compared to the Revised Second Basis of Comparison.

7 **5C.2.2.3.7 CVP Stanislaus Deliveries**

8 Under Alternative 3, annual CVP service contract deliveries were increased by
 9 15.1 TAF and annual water rights deliveries were increased by 2.6 TAF when
 10 compared to the Second Basis of Comparison.

11 When compared to the Revised Second Basis of Comparison, annual CVP service
 12 contract deliveries are increased by 4.8 TAF; however annual water rights
 13 deliveries are decreased by 1.2 TAF under Alternative 3.

14 In general, the Alternative 3 shows increased Stanislaus deliveries to CVP service
 15 contractors and similar (slightly decreased) deliveries to water right holders when
 16 compared to the Revised Second Basis of Comparison.

17 **5C.2.2.3.8 CVP Power Generation**

18 Under Alternative 3, long-term average power capacity was 1% higher and energy
 19 generation was similar when compared to the Second Basis of Comparison. The
 20 energy use at the CVP pumping facilities was 4% lower than the Second Basis of
 21 Comparison; which resulted in a 1% higher net generation.

22 In dry and critical years, long-term average power capacity and energy generation
 23 under Alternative 3 were both 1% lower than the Second Basis of Comparison.
 24 The energy use at the CVP pumping facilities was 8% lower than the Second
 25 Basis of Comparison; which resulted in 4% higher net generation.

26 When compared to the Revised Second Basis of Comparison, long-term average
 27 power capacity and energy generation are both 1% lower under Alternative 3.
 28 The energy use at the CVP pumping facilities is 4% lower than the Revised
 29 Second Basis of Comparison; which results in similar net generation.

30 In dry and critical years, long-term average power capacity and energy generation
 31 under Alternative 3 are 3% and 1% lower than the Revised Second Basis of
 32 Comparison. The energy use at the CVP pumping facilities is 7% lower than the
 33 Revised Second Basis of Comparison; which results 1% higher net generation.

34 **5C.2.2.3.9 New Melones Large Mouth Bass Nest Survival Percentage**

35 Monthly pattern of reservoir storage is different between the Second Basis of
 36 Comparison and the Revised Second Basis of Comparison and the changes
 37 between alternatives reflect the change in this pattern.

- 38 • In wet years, Alternative 3 showed higher percentage of nest survival in July
 39 through September (from approximately 5% and 45%); and lower percentage

Appendix 5C: Revised Second Basis of Comparison

1 of nest survival (7% and 6%) in May and June when compared to the Second
2 Basis of Comparison.

3 When compared to the Revised Second Basis of Comparison, Alternative 3
4 shows higher percentage of nest survival (from approximately 12 to 62%) in
5 July through September; and lower percentage of nest survival (approximately
6 7 and 20%) in May and June.

7 • In above normal years, Alternative 3 showed higher percentage of nest
8 survival in June through August (from approximately 10% to 38 when
9 compared to the Second Basis of Comparison.

10 When compared to the Revised Second Basis of Comparison, Alternative 3
11 shows lower percentage of nest survival in June (approximately 6 %) in
12 August; and higher percentage of nest survival (approximately 24% and 17%)
13 in June and July.

14 • In below normal years, Alternative 3 showed higher percentage of nest
15 survival (approximately 15%) in May and June; and lower percentage of nest
16 survival (from approximately 9% and 21%) in December, April, and July
17 when compared to the Second Basis of Comparison.

18 When compared to the Revised Second Basis of Comparison, Alternative 3
19 shows lower percentage of nest survival (from approximately 7 to 18%) in
20 December, April, July, and August.

21 • In dry years, Alternative 3 showed higher percentage of nest survival (from
22 approximately 5% to 21%) in February, June, and August; and lower
23 percentage of nest survival (approximately 20% and 17%) in April and
24 September when compared to the Second Basis of Comparison.

25 When compared to the Revised Second Basis of Comparison, Alternative 3
26 shows lower percentage of nest survival (from approximately 7 to 23%) in
27 October, April, May, July, and September.

28 • In critically dry years, Alternative 3 showed higher percentage of nest survival
29 (approximately 7% to 56%) in February and May; and lower percentage of
30 nest survival (from approximately 5% and 37%) in, April, and June through
31 September when compared to the Second Basis of Comparison.

32 When compared to the Revised Second Basis of Comparison, Alternative 3
33 shows higher percentage of nest survival (approximately 25%) in August; and
34 lower percentage of nest survival (from approximately 10 to 28%) in April,
35 May, July, and September.

36 In general, the Alternative 3 shows lower percentage of nest survival for the New
37 Melones Large Mouth Bass when compared to the Revised Second Basis of
38 Comparison except for summer months of wet years.

5C.2.2.3.10 New Melones Small Mouth Bass Nest Survival Percentage

Monthly pattern of reservoir storage is different between the Second Basis of Comparison and the Revised Second Basis of Comparison and the changes between alternatives reflect the change in this pattern.

- In wet years, Alternative 3 showed higher percentage of nest survival in July and August (approximately 53% and 24%); and lower percentage of nest survival (approximately 7%) in May when compared to the Second Basis of Comparison.

When compared to the Revised Second Basis of Comparison, Alternative 3 shows higher percentage of nest survival (from approximately 12 to 72%) in July through September; and lower percentage of nest survival (approximately 8 and 18%) in May and June.

- In above normal years, Alternative 3 showed higher percentage of nest survival in June through August (from approximately 8% to 35%) when compared to the Second Basis of Comparison.

When compared to the Revised Second Basis of Comparison, Alternative 3 shows lower percentage of nest survival (approximately 7%) in August; and higher percentage of nest survival (approximately 28% and 16%) in June and July.

- In below normal years, the Alternative 3 showed higher percentage of nest survival (from approximately 7% to 16%) in November, May, and June; and lower percentage of nest survival (from approximately 9% to 23%) in December, April, and July when compared to the Second Basis of Comparison.

When compared to the Revised Second Basis of Comparison, the Alternative 3 shows lower percentage of nest survival (from approximately 8 to 18%) in December, April, July, and August.

- In dry years, the Alternative 3 showed higher percentage of nest survival (from approximately 5% to 19%) in February, June, and August; and lower percentage of nest survival (approximately 20% and 16%) in April, and September when compared to the Second Basis of Comparison.

When compared to the Revised Second Basis of Comparison, the Alternative 3 shows lower percentage of nest survival (from approximately 7 to 22%) in October, April, May, July, and September.

- In critically dry years, the Alternative 3 showed higher percentage of nest survival (from approximately 8 to 51%) in February and May; and lower percentage of nest survival (from approximately 8% to 40%) in April, and June through September when compared to the Second Basis of Comparison.

When compared to the Revised Second Basis of Comparison, the Alternative 3 shows higher percentage of nest survival (from approximately 5 to 31%) in February and August; and lower percentage of nest survival

1 (from approximately 8% to 27%) in October, April, May, July, and
2 September.

3 In general, the Alternative 3 shows lower percentage of nest survival for the New
4 Melones Small Mouth Bass when compared to the Revised Second Basis of
5 Comparison.

6 **5C.2.2.3.11 New Melones Spotted Bass Nest Survival Percentage**

7 Monthly pattern of reservoir storage is different between the Second Basis of
8 Comparison and the Revised Second Basis of Comparison and the changes
9 between alternatives reflect the change in this pattern.

- 10 • In wet years, Alternative 3 showed lower percentage of nest survival (from
11 approximately 8% to 22%) in May and June when compared to the Second
12 Basis of Comparison.

13 When compared to the Revised Second Basis of Comparison, Alternative 3
14 shows higher percentage of nest survival (from approximately 5% to 8%) in
15 August and September; and lower percentage of nest survival (approximately
16 8% and 23%) in May and June.

- 17 • In above normal years, Alternative 3 showed lower percentage of nest survival
18 (from approximately 8% to 35%) in August and September when compared to
19 the Second Basis of Comparison.

20 When compared to the Revised Second Basis of Comparison, Alternative 3
21 shows lower percentage of nest survival (from approximately 8% to 18%) in
22 August and September.

- 23 • In below normal years, the Alternative 3 showed higher percentage of nest
24 survival (from approximately 5% to 6%) in May and June; and lower
25 percentage of nest survival (from approximately 9% to 18%) in December,
26 April, July, and August when compared to the Second Basis of Comparison.

27 When compared to the Revised Second Basis of Comparison, the
28 Alternative 3 shows lower percentage of nest survival (from approximately
29 9% to 18%) in December, April, July, and August.

- 30 • In dry years, the Alternative 3 showed lower percentage of nest survival (from
31 approximately 6% to 21%) in April, May, July and September when
32 compared to the Second Basis of Comparison.

33 When compared to the Revised Second Basis of Comparison, the
34 Alternative 3 shows lower percentage of nest survival (from approximately
35 7 to 24%) in April, May, and July through September.

- 36 • In critically dry years, the Alternative 3 showed higher percentage of nest
37 survival (from approximately 5% to 26%) in May and June; and lower
38 percentage of nest survival (from approximately 7% to 10%) in March, April,
39 and September when compared to the Second Basis of Comparison.

1 When compared to the Revised Second Basis of Comparison, the
 2 Alternative 3 shows lower percentage of nest survival (from approximately
 3 6% to 10%) in March through May, July, and September.

4 In general, the Alternative 3 shows lower percentage of nest survival for the New
 5 Melones Spotted Bass when compared to the Revised Second Basis of
 6 Comparison.

7 **5C.2.2.4 Alternative 5 Compared to the Revised Second Basis of**
 8 **Comparison**

9 **5C.2.2.4.1 New Melones Storage**

10 Alternative 5 showed decreased storage (from approximately 6 to 23%) almost all
 11 months of all water year types except for June through September of wet years
 12 (less than 5% decrease). When compared to the Revised Second Basis of
 13 Comparison, Alternative 5 shows further decreased storage (from approximately
 14 8 to 43%) in all months of all water year types.

15 **5C.2.2.4.2 New Melones Elevation**

16 Alternative 5 showed similar reservoir elevation (changes within 5%) in all
 17 months of all water year types. When compared to the Revised Second Basis of
 18 Comparison, Alternative 5 shows decreased storage in all months of all water year
 19 types (from approximately 9 to 13%).

20 **5C.2.2.4.3 Stanislaus River Flow below Goodwin**

21 Flow patterns are different between the Second Basis of Comparison and the
 22 Revised Second Basis of Comparison and the changes between alternatives reflect
 23 the change in patterns.

- 24 • In wet years, Alternative 5 showed lower flows (from approximately 6 to
 25 53%) in November, December, January, and June through September, higher
 26 flows (from approximately 16 to 113%) in October, March, and May, and
 27 similar flows (within 5% change) in February and April when compared to the
 28 Second Basis of Comparison.

29 When compared to the Revised Second Basis of Comparison, Alternative 5
 30 shows lower flows (from approximately 14 to 40%) in November, December,
 31 February, and June through September, higher flows (from approximately
 32 11 to 129%) in October, March, and May, and similar flows (within 5%
 33 change) in January and April when compared to Alternative 5.

- 34 • In above normal years, Alternative 5 showed lower flows (from
 35 approximately 7 to 37%) in November through February and June, higher
 36 flows (from approximately 23 to 134%) in October, March, April, and May,
 37 and similar flows (within 5% change) in July, August, and September when
 38 compared to the Second Basis of Comparison.

39 When compared to the Revised Second Basis of Comparison, Alternative 5
 40 shows lower flows (from approximately 7 to 22%) in November, December,

1 and February, higher flows (from approximately 11 to 185%) in October,
2 March, April, and May, and similar flows (within 5% change) in January and
3 June through September when compared to Alternative 5.

- 4 • In below normal years, Alternative 5 showed lower flows (from
5 approximately 5 to 40%) in November through February, June, and
6 September, higher flows (from approximately 16 to 155%) in October, March,
7 and April, and similar flows (within 5% change) in May, July, and August
8 when compared to the Second Basis of Comparison.

9 When compared to the Revised Second Basis of Comparison, Alternative 5
10 shows lower flows (from approximately 16 to 35%) in November through
11 February, higher flows (from approximately 11 to 189%) in October and
12 March through June, and similar flows (within 5% change) in July through
13 September.

- 14 • In dry years, Alternative 5 showed lower flows (approximately 8 to 36%) in,
15 November through March and June, higher flows (approximately 25 to 148%)
16 in October, April, and May, and similar flows (within 5% change) in July
17 through September when compared to the Second Basis of Comparison.

18 When compared to the Revised Second Basis of Comparison, Alternative 5
19 shows lower flows (approximately 8 to 26%) in November through February,
20 higher flows (from approximately 8 to 182%) in October and March through
21 June, and similar flows (within 5% change) in July through September.

- 22 • In critically dry years, Alternative 5 showed lower flows (approximately 8 to
23 30%) in November through March, Jun, and July, higher flows
24 (approximately 7 to 193%) in October, April, and May, and similar flows
25 (within 5% change) in August and September when compared to the Second
26 Basis of Comparison.

27 When compared to the Revised Second Basis of Comparison, Alternative 5
28 shows lower flows (from approximately 5 to 17%) in November, December,
29 February, June, July, and August, higher flows (from approximately 8 to
30 272%) in October, January, March, April, and May, and similar flows (within
31 5% change) in September.

32 **5C.2.2.4.4 Stanislaus River Flow at Mouth**

33 Flow patterns are different between the Second Basis of Comparison and the
34 Revised Second Basis of Comparison and the changes between alternatives reflect
35 the change in patterns.

- 36 • In wet years, Alternative 5 showed lower flows (from approximately 5 to
37 47%) in November, December, January, and June through September, higher
38 flows (from approximately 14 to 77%) in October, March, and May, and
39 similar flows (within 5% change) in February and April when compared to the
40 Second Basis of Comparison.

41 When compared to the Revised Second Basis of Comparison, Alternative 5
42 shows lower flows (from approximately 12 to 34%) in November, December,

- 1 February, and June through September, higher flows (from approximately
 2 10 to 86%) in October, March, and May, and similar flows (within 5%
 3 change) in January and April when compared to Alternative 5.
- 4 • In above normal years, Alternative 5 showed lower flows (from
 5 approximately 6 to 26%) in November through February and June, higher
 6 flows (from approximately 18 to 82%) in October, March, April, and May,
 7 and similar flows (within 5% change) in July, August, and September when
 8 compared to the Second Basis of Comparison.
- 9 When compared to the Revised Second Basis of Comparison, Alternative 5
 10 shows lower flows (from approximately 6 to 15%) in November, December,
 11 and February, higher flows (from approximately 8 to 104%) in October,
 12 March, April, and May, and similar flows (within 5% change) in January and
 13 June through September when compared to Alternative 5.
- 14 • In below normal years, Alternative 5 showed lower flows (from
 15 approximately 12 to 34%) in November through February and June, higher
 16 flows (from approximately 10 to 93%) in October, March, and April, and
 17 similar flows (within 5% change) in May, July, August, and September when
 18 compared to the Second Basis of Comparison.
- 19 When compared to the Revised Second Basis of Comparison, Alternative 5
 20 shows lower flows (from approximately 11 to 27%) in November through
 21 February, higher flows (from approximately 8 to 108%) in October and March
 22 through June, and similar flows (within 5% change) in July through
 23 September.
- 24 • In dry years, Alternative 5 showed lower flows (approximately 6 to 28%) in,
 25 November through March and June, higher flows (approximately 23 to 142%)
 26 in October, April, and May, and similar flows (within 5% change) in July
 27 through September when compared to the Second Basis of Comparison.
- 28 When compared to the Revised Second Basis of Comparison, Alternative 5
 29 shows lower flows (approximately 6 to 20%) in November through February,
 30 higher flows (from approximately 77 to 107%) in October, April, and May,
 31 and similar flows (within 5% change) in March and June through September.
- 32 • In critically dry years, Alternative 5 showed lower flows (approximately 7 to
 33 24%) in November through March, Jun, and July, higher flows
 34 (approximately 7 to 149%) in October, April, and May, and similar flows
 35 (within 5% change) in August and September when compared to the Second
 36 Basis of Comparison.
- 37 When compared to the Revised Second Basis of Comparison, Alternative 5
 38 shows lower flows (from approximately 6 to 13%) in November, December,
 39 June, July, and August, higher flows (from approximately 6 to 147%) in
 40 October, January, March, April, and May, and similar flows (within 5%
 41 change) in February and September.

1 **5C.2.2.4.5 Stanislaus River Water Temperature below Goodwin Dam**

2 Alternative 5 showed similar temperatures at Goodwin except for higher
3 temperatures in October of wet years, October, July, August, and September of
4 below normal years, October, November, July, August, and September of dry
5 years, October, April, May, August, and September of critically dry years (varied
6 from 0.5 to 1.9°F), and lower temperatures in December and February of critically
7 dry years (approximately 0.5°F) when compared to the Second Basis of
8 Comparison. Difference in temperature threshold exceedances were within 5%
9 (varied from 1% less to 2% more exceedances in February, March, and May) and
10 higher (approximately 6%) in April.

11 Alternative 5 shows similar temperatures at Goodwin except for higher
12 temperatures in October of wet years, October, November, August and September
13 of above normal years, October, August, and September of below normal years,
14 October through December and July through September of dry years, October,
15 November, May, and July through September of critically dry years (varied from
16 0.5 to 2.5°F) when compared to the Revised Second Basis of Comparison.
17 Difference in temperature threshold exceedances are within 5% (varied from 4%
18 less to 3% more exceedances in January through April).

19 In general, Alternative 5 shows lower temperatures for Steelhead smolts in
20 Stanislaus when compared to the Revised Second Basis of Comparison.

21 **5C.2.2.4.6 Stanislaus River Water Temperature at Orange Blossom Bridge**

22 Alternative 5 showed similar temperatures at Orange Blossom Bridge except for
23 lower temperatures in October of wet years, October and April of above normal,
24 below normal, dry, and critically dry years (from approximately 0.7 to 1.6°F) and
25 higher temperatures in November and June of wet years, June and September of
26 below normal years, August and September of dry years, and June through
27 September of critically dry years (approximately from 0.5 to 1.3°F) when
28 compared to the Second Basis of Comparison. Difference in temperature
29 threshold exceedances showed 27% less exceedance in October (adult migration
30 threshold), 8% less exceedance in April (smoltification threshold), 26% less
31 exceedance in April (spawning threshold), 8% more exceedance in November
32 (adult migration threshold), 6% more exceedance in April (smoltification
33 threshold), and 6 % more exceedance in July (rearing threshold), and 8% more in
34 August and September (rearing threshold).

35 Alternative 5 shows similar temperatures at Orange Blossom Bridge except for
36 lower temperatures (from approximately 0.5 to 1.7°F) in October and March of
37 wet years, October, March, and May of above normal years, October of below
38 normal years, October, April, and May of dry years, and October, March, April,
39 and May of critically dry years; and higher temperatures (from approximately
40 0.6 to 1.7°F) in July through September of wet years, November and September
41 of above normal years, September of below normal years, November, and July
42 through September of dry years, and November and June through September of
43 critically dry years when compared to the Revised Second Basis of Comparison.
44 Difference in temperature threshold exceedances showed 28% less exceedance in

1 October (adult migration threshold), 10% less exceedance in March
 2 (smoltification threshold), 7% less exceedance in April (smoltification threshold),
 3 15% less exceedance in May (smoltification threshold), 15, 23, and 17% less
 4 exceedance in March, April, and May respectively (spawning threshold), and 9%
 5 more in November (adult migration threshold) , and 7, 13, and 11% more in July,
 6 August, and September respectively (rearing threshold).

7 In general, Alternative 5 shows lower temperatures for Steelhead lifestages in
 8 Stanislaus except for higher temperatures when Steelhead is rearing in summer;
 9 when compared to the Revised Second Basis of Comparison.

10 **5C.2.2.4.7 CVP Stanislaus Deliveries**

11 Under Alternative 5, annual CVP service contract deliveries were decreased by
 12 8.4 TAF and annual water rights deliveries were decreased by 8.1 TAF when
 13 compared to the Second Basis of Comparison.

14 When compared to the Revised Second Basis of Comparison, annual CVP service
 15 contract deliveries are decreased by 18.6 TAF and annual water rights deliveries
 16 are decreased by 11.9 TAF under Alternative 5.

17 In general, the Alternative 5 shows decreased CVP Stanislaus deliveries when
 18 compared to the Revised Second Basis of Comparison.

19 **5C.2.2.4.8 CVP Power Generation**

20 Under Alternative 5, long-term average power capacity and energy generation
 21 were 4% and 1% lower when compared to the Second Basis of Comparison. The
 22 energy use at the CVP pumping facilities was 14% lower than the Second Basis of
 23 Comparison; which resulted in a 4% higher net generation.

24 In dry and critical years, long-term average power capacity and energy generation
 25 under Alternative 5 were both 1% lower than the Second Basis of Comparison.
 26 The energy use at the CVP pumping facilities was 8% lower than the Second
 27 Basis of Comparison; which resulted in 4% higher net generation.

28 When compared to the Revised Second Basis of Comparison, long-term average
 29 power capacity and energy generation are 5% and 1% lower under Alternative 5.
 30 The energy use at the CVP pumping facilities is 14% lower than the Revised
 31 Second Basis of Comparison; which results in 3% higher net generation.

32 In dry and critical years, long-term average power capacity and energy generation
 33 under Alternative 5 are 12% and 5% lower than the Revised Second Basis of
 34 Comparison. The energy use at the CVP pumping facilities is 9% lower than the
 35 Revised Second Basis of Comparison; which results 3% lower net generation.

36 **5C.2.2.4.9 New Melones Large Mouth Bass Nest Survival Percentage**

37 Monthly pattern of reservoir storage is different between the Second Basis of
 38 Comparison and the Revised Second Basis of Comparison and the changes
 39 between alternatives reflect the change in this pattern.

Appendix 5C: Revised Second Basis of Comparison

- 1 • In wet years, Alternative 5 showed higher percentage of nest survival in June
2 (approximately 19%); and lower percentage of nest survival (from
3 approximately 5% through 28%) in October, April, May, and July through
4 August when compared to the Second Basis of Comparison.
- 5 When compared to the Revised Second Basis of Comparison, Alternative 5
6 shows lower percentage of nest survival (from approximately 5% to 28%) in
7 October, May, and August.
- 8 • In above normal years, the Alternative 5 showed lower percentage of nest
9 survival (from 6% to 23%) in October and April through September when
10 compared to the Second Basis of Comparison.
- 11 When compared to the Revised Second Basis of Comparison, the
12 Alternative 5 shows lower percentage of nest survival (from approximately
13 6 to 29%) in October and April through September.
- 14 • In below normal years, the Alternative 5 showed higher percentage of nest
15 survival (approximately 6%) in June; and lower percentage of nest survival
16 (from approximately 5% and 38%) in October, March, April, May, and July
17 through September when compared to the Second Basis of Comparison.
- 18 When compared to the Revised Second Basis of Comparison, the
19 Alternative 5 shows lower percentage of nest survival (from approximately
20 5 to 40%) in October and March through September.
- 21 • In dry years, the Alternative 5 showed higher percentage of nest survival
22 (approximately 5%) in February; and lower percentage of nest survival (from
23 approximately 11% and 47%) in October, April, May, and July through
24 September when compared to the Second Basis of Comparison.
- 25 When compared to the Revised Second Basis of Comparison, Alternative 5
26 shows lower percentage of nest survival (from approximately 9 to 45%) in
27 October and April through September.
- 28 • In critically dry years, Alternative 5 showed higher percentage of nest survival
29 (from approximately 5 to 82%) in February, and June through September and
30 lower percentage of nest survival (approximately 21% and 69%) in October,
31 and April when compared to the Second Basis of Comparison.
- 32 When compared to the Revised Second Basis of Comparison, Alternative 5
33 shows higher percentage of nest survival (from approximately 17 to 148%) in
34 June through September; and lower percentage of nest survival (from
35 approximately 26 to 67%) in October, April, and May.
- 36 In general, the Alternative 5 shows lower percentage of nest survival for the New
37 Melones Large Mouth Bass when compared to the Revised Second Basis of
38 Comparison except for summer months of the critically dry years.

1 **5C.2.2.4.10 New Melones Small Mouth Bass Nest Survival Percentage**

2 Monthly pattern of reservoir storage is different between the Second Basis of
 3 Comparison and the Revised Second Basis of Comparison and the changes
 4 between alternatives reflect the change in this pattern.

- 5 • In wet years, Alternative 5 showed higher percentage of nest survival in June
 6 (approximately 19%); and lower percentage of nest survival (from
 7 approximately 7% through 34%) in October, May, and July through
 8 September when compared to the Second Basis of Comparison.

9 When compared to the Revised Second Basis of Comparison, Alternative 5
 10 shows lower percentage of nest survival (from approximately 5% to 35%) in
 11 October, May, and August.

- 12 • In above normal years, the Alternative 5 showed lower percentage of nest
 13 survival (from 7% to 28%) in October and April through September when
 14 compared to the Second Basis of Comparison.

15 When compared to the Revised Second Basis of Comparison, the
 16 Alternative 5 shows lower percentage of nest survival (from approximately
 17 7 to 29%) in October and April through September.

- 18 • In below normal years, the Alternative 5 showed higher percentage of nest
 19 survival (approximately 8%) in June; and lower percentage of nest survival
 20 (from approximately 6% and 39%) in October, March, April, May, and July
 21 through September when compared to the Second Basis of Comparison.

22 When compared to the Revised Second Basis of Comparison, the
 23 Alternative 5 shows lower percentage of nest survival (from approximately
 24 6 to 41%) in October and March through September.

- 25 • In dry years, the Alternative 5 showed higher percentage of nest survival
 26 (approximately 5%) in November and February; and lower percentage of nest
 27 survival (from approximately 11% and 45%) in October, April, May, and July
 28 through September when compared to the Second Basis of Comparison.

29 When compared to the Revised Second Basis of Comparison, Alternative 5
 30 shows lower percentage of nest survival (from approximately 9 to 48%) in
 31 October, and April through September.

- 32 • In critically dry years, Alternative 5 showed higher percentage of nest survival
 33 (from approximately 5 to 92%) in November, February, and May through
 34 September and lower percentage of nest survival (approximately 26% and
 35 67%) in October and April when compared to the Second Basis of
 36 Comparison.

37 When compared to the Revised Second Basis of Comparison, Alternative 5
 38 shows higher percentage of nest survival (from approximately 28 to 179%) in
 39 June through September; and lower percentage of nest survival (from
 40 approximately 31 to 65%) in October, April and May.

1 In general, the Alternative 5 shows lower percentage of nest survival for the New
2 Melones Small Mouth Bass when compared to the Revised Second Basis of
3 Comparison except for summer months of the critically dry years.

4 **5C.2.2.4.11 New Melones Spotted Bass Nest Survival Percentage**

5 Monthly pattern of reservoir storage is different between the Second Basis of
6 Comparison and the Revised Second Basis of Comparison and the changes
7 between alternatives reflect the change in this pattern.

8 • In wet years, Alternative 5 showed lower percentage of nest survival
9 (approximately 8%) in August when compared to the Second Basis of
10 Comparison.

11 When compared to the Revised Second Basis of Comparison, Alternative 5
12 shows lower percentage of nest survival (approximately 6%) in August.

13 • In above normal years, the Alternative 5 showed lower percentage of nest
14 survival (from 8% to 21%) in April, June, July and September when compared
15 to the Second Basis of Comparison.

16 When compared to the Revised Second Basis of Comparison, the
17 Alternative 5 shows lower percentage of nest survival (from approximately
18 8% to 24%) in April, and June through September.

19 • In below normal years, the Alternative 5 showed lower percentage of nest
20 survival (from approximately 13% and 22%) in October, April, May, and July
21 through September when compared to the Second Basis of Comparison.

22 When compared to the Revised Second Basis of Comparison, the
23 Alternative 5 shows lower percentage of nest survival (from approximately
24 6% to 22%) in October, and April through September.

25 • In dry years, the Alternative 5 showed lower percentage of nest survival (from
26 approximately 6% and 22%) in October, and April through September when
27 compared to the Second Basis of Comparison.

28 When compared to the Revised Second Basis of Comparison, Alternative 5
29 shows lower percentage of nest survival (from approximately 6% to 28%) in
30 October, and April through September.

31 • In critically dry years, Alternative 5 showed higher percentage of nest survival
32 (from approximately 13% to 18%) in July and August; and lower percentage
33 of nest survival (approximately 31% and 57%) in April and May when
34 compared to the Second Basis of Comparison.

35 When compared to the Revised Second Basis of Comparison, Alternative 5
36 shows higher percentage of nest survival (from approximately 5% to 13%) in
37 July and August; and lower percentage of nest survival (from approximately
38 7% to 56%) in April, May, and September.

1 In general, the Alternative 5 shows lower percentage of nest survival for the New
2 Melones Spotted Bass when compared to the Revised Second Basis of
3 Comparison except for summer months of the critically dry years.

4 **5C.3 Results**

5 **5C.3.1 Revised Second Basis of Comparison vs. Second Basis of** 6 **Comparison Results**

- 7 5C.3.1.1 Trinity Storage
- 8 5C.3.1.2 Shasta Storage
- 9 5C.3.1.3 Oroville Storage
- 10 5C.3.1.4 Folsom Storage
- 11 5C.3.1.5 New Melones Storage
- 12 5C.3.1.6 Trinity Elevation
- 13 5C.3.1.7 Shasta Elevation
- 14 5C.3.1.8 Oroville Elevation
- 15 5C.3.1.9 Folsom Elevation
- 16 5C.3.1.10 New Melones Elevation
- 17 5C.3.1.11 Delta Outflow
- 18 5C.3.1.12 Exports through Jones and Banks Pumping Plants
- 19 5C.3.1.13 Trinity River below Lewiston Dam
- 20 5C.3.1.14 Clear Creek below Whiskeytown Dam
- 21 5C.3.1.15 Sacramento River downstream of Keswick Reservoir
- 22 5C.3.1.16 Feather River downstream of Thermalito Afterbay
- 23 5C.3.1.17 Fremont Weir Spills
- 24 5C.3.1.18 American River below Nimbus Dam
- 25 5C.3.1.19 Sacramento River at Freeport
- 26 5C.3.1.20 Yolo Bypass Flow
- 27 5C.3.1.21 San Joaquin River at Vernalis Flow
- 28 5C.3.1.22 San Joaquin River at Vernalis Salinity
- 29 5C.3.1.23 Stanislaus River below Goodwin Flow
- 30 5C.3.1.24 Stanislaus River at Mouth Flow

1 **5C.3.2 Revised Second Basis of Comparison vs. Second Basis of**
2 **Comparison Results**

- 3 5C.3.2.1 New Melones Storage
- 4 5C.3.2.2 New Melones Elevation
- 5 5C.3.2.3 Stanislaus River below Goodwin Flow
- 6 5C.3.2.4 Stanislaus River at Mouth Flow
- 7 5C.3.2.5 Stanislaus River below New Melones Reservoir Temperature
- 8 5C.3.2.6 Stanislaus River below Tulloch Reservoir Temperature
- 9 5C.3.2.7 Stanislaus River below Goodwin Dam Temperature
- 10 5C.3.2.8 Stanislaus River at Orange Blossom Bridge Temperature
- 11 5C.3.2.9 Stanislaus River at Mouth Temperature
- 12 5C.3.2.10 San Joaquin River at Vernalis Flow
- 13 5C.3.2.11 Delta Outflow
- 14 5C.3.2.12 X2 Position
- 15 5C.3.2.13 Old and Middle River Flow
- 16 5C.3.2.14 Exports through Jones and Banks Pumping Plant
- 17 5C.3.2.15 CVP Deliveries
- 18 5C.3.2.16 CVP Total Capacity
- 19 5C.3.2.17 CVP Total Generation
- 20 5C.3.2.18 CVP Total Energy Use
- 21 5C.3.2.19 CVP Net Generation
- 22 5C.3.2.20 Salmon Mortality
- 23 5C.3.2.21 New Melones Large Mouth Bass Nest Survival Percentage
- 24 5C.3.2.22 New Melones Small Mouth Bass Nest Survival Percentage
- 25 5C.3.2.23 New Melones Spotted Bass Nest Survival Percentage
- 26 5C.3.2.24 Temperature Threshold Exceedances
- 27 5C.3.2.25 CVP Annual Power Generation Summary

28 **5C.3.3 Second Basis of Comparison vs. No Action Alternative,**
29 **Alternative 3, and Alternative 5 Results**

- 30 5C.3.3.1 New Melones Storage
- 31 5C.3.3.2 New Melones Elevation
- 32 5C.3.3.3 Stanislaus River below Goodwin Flow
- 33 5C.3.3.4 Stanislaus River at Mouth Flow

- 1 5C.3.3.5 Stanislaus River below New Melones Reservoir Temperature
- 2 5C.3.3.6 Stanislaus River below Tulloch Reservoir Temperature
- 3 5C.3.3.7 Stanislaus River below Goodwin Dam Temperature
- 4 5C.3.3.8 Stanislaus River at Orange Blossom Bridge Temperature
- 5 5C.3.3.9 Stanislaus River at Mouth Temperature
- 6 5C.3.3.10 San Joaquin River at Vernalis Flow
- 7 5C.3.3.11 Delta Outflow
- 8 5C.3.3.12 X2 Position
- 9 5C.3.3.13 Old and Middle River Flow
- 10 5C.3.3.14 Exports through Jones and Banks Pumping Plant
- 11 5C.3.3.15 CVP Deliveries
- 12 5C.3.3.16 CVP Total Capacity
- 13 5C.3.3.17 CVP Total Generation
- 14 5C.3.3.18 CVP Total Energy Use
- 15 5C.3.3.19 CVP Net Generation
- 16 5C.3.3.20 Salmon Mortality
- 17 5C.3.3.21 New Melones Large Mouth Bass Nest Survival Percentage
- 18 5C.3.3.22 New Melones Small Mouth Bass Nest Survival Percentage
- 19 5C.3.3.23 New Melones Spotted Bass Nest Survival Percentage
- 20 5C.3.3.24 Temperature Threshold Exceedances
- 21 5C.3.3.25 CVP Annual Power Generation Summary

This page left blank intentionally.

Table 5C.3.1.1 Trinity Lake, End of Month Storage

Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,850	1,850	1,850	1,900	2,000	2,100	2,298	2,345	2,302	2,253	2,143	1,975
20%	1,804	1,840	1,850	1,900	2,000	2,100	2,255	2,276	2,193	2,055	1,920	1,822
30%	1,576	1,594	1,740	1,816	1,981	2,091	2,222	2,159	2,074	1,924	1,793	1,645
40%	1,391	1,446	1,568	1,705	1,855	2,019	2,131	2,030	1,918	1,767	1,582	1,426
50%	1,267	1,266	1,396	1,567	1,685	1,818	2,012	1,912	1,773	1,601	1,416	1,304
60%	1,174	1,201	1,230	1,335	1,535	1,709	1,778	1,749	1,677	1,497	1,330	1,218
70%	1,106	1,099	1,179	1,216	1,362	1,484	1,645	1,599	1,537	1,400	1,225	1,111
80%	948	954	983	1,052	1,132	1,274	1,453	1,434	1,338	1,168	1,055	976
90%	634	645	672	724	810	921	1,051	975	917	802	689	651
Long Term												
Full Simulation Period ^b	1,269	1,288	1,352	1,431	1,554	1,678	1,819	1,796	1,727	1,583	1,434	1,319
Water Year Types^c												
Wet (32%)	1,501	1,535	1,644	1,767	1,931	2,055	2,224	2,250	2,194	2,068	1,939	1,805
Above Normal (16%)	1,208	1,245	1,363	1,524	1,718	1,901	2,079	2,053	1,955	1,815	1,647	1,513
Below Normal (13%)	1,451	1,472	1,492	1,554	1,641	1,729	1,872	1,799	1,696	1,515	1,337	1,204
Dry (24%)	1,178	1,184	1,210	1,230	1,322	1,453	1,586	1,536	1,466	1,302	1,152	1,055
Critical (15%)	819	803	813	825	868	949	999	962	929	811	667	598

Revised Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,850	1,850	1,850	1,900	2,000	2,100	2,298	2,345	2,303	2,253	2,143	1,975
20%	1,805	1,840	1,850	1,900	2,000	2,100	2,257	2,276	2,199	2,059	1,922	1,822
30%	1,577	1,591	1,725	1,816	1,979	2,084	2,222	2,159	2,074	1,924	1,791	1,643
40%	1,386	1,446	1,567	1,701	1,865	2,023	2,131	2,029	1,919	1,767	1,588	1,422
50%	1,265	1,284	1,398	1,563	1,694	1,820	2,024	1,915	1,777	1,599	1,419	1,307
60%	1,173	1,200	1,226	1,341	1,538	1,709	1,778	1,749	1,671	1,497	1,329	1,218
70%	1,105	1,092	1,183	1,209	1,356	1,483	1,643	1,592	1,533	1,398	1,221	1,106
80%	942	958	979	1,053	1,143	1,267	1,442	1,429	1,332	1,166	1,054	972
90%	633	630	640	720	808	921	1,064	994	939	816	690	640
Long Term												
Full Simulation Period ^b	1,270	1,288	1,352	1,431	1,554	1,678	1,819	1,796	1,727	1,583	1,435	1,319
Water Year Types^c												
Wet (32%)	1,502	1,536	1,645	1,768	1,931	2,055	2,224	2,250	2,194	2,068	1,939	1,804
Above Normal (16%)	1,207	1,245	1,363	1,524	1,718	1,902	2,082	2,056	1,959	1,819	1,650	1,517
Below Normal (13%)	1,446	1,467	1,486	1,551	1,638	1,726	1,868	1,796	1,692	1,510	1,334	1,203
Dry (24%)	1,178	1,184	1,210	1,230	1,322	1,452	1,585	1,536	1,466	1,299	1,151	1,055
Critical (15%)	825	806	817	827	870	951	1,002	966	933	814	673	600

Revised Second Basis of Comparison minus Second Basis of Comparison

Statistic	End of Month Storage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	1%	0%	0%	0%	0%	0%	0%	0%
50%	0%	1%	0%	0%	1%	0%	1%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	-1%	0%	-1%	0%	0%	0%	0%	0%	0%	0%	0%
80%	-1%	0%	0%	0%	1%	-1%	-1%	0%	0%	0%	0%	0%
90%	0%	-2%	-5%	-1%	0%	0%	1%	2%	2%	2%	0%	-2%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.1.2 Shasta Lake, End of Month Storage

Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,250	3,252	3,359	3,632	3,911	4,222	4,499	4,552	4,434	3,902	3,563	3,400
20%	3,247	3,252	3,333	3,552	3,771	4,118	4,448	4,552	4,283	3,767	3,380	3,330
30%	3,127	3,199	3,304	3,513	3,673	4,018	4,384	4,532	4,155	3,546	3,174	3,096
40%	2,924	3,028	3,254	3,382	3,569	3,978	4,290	4,375	3,913	3,291	2,980	2,935
50%	2,689	2,753	3,134	3,314	3,487	3,916	4,175	4,245	3,712	3,139	2,781	2,738
60%	2,520	2,594	2,922	3,170	3,354	3,727	4,064	3,971	3,493	2,942	2,636	2,592
70%	2,345	2,467	2,643	2,891	3,252	3,513	3,886	3,757	3,332	2,790	2,527	2,453
80%	2,099	2,145	2,178	2,609	2,978	3,409	3,640	3,525	2,951	2,410	2,127	2,125
90%	1,414	1,350	1,524	2,050	2,383	2,760	2,722	2,958	2,604	1,986	1,584	1,526
Long Term												
Full Simulation Period ^b	2,530	2,578	2,753	3,020	3,285	3,639	3,913	3,907	3,539	3,007	2,674	2,607
Water Year Types^c												
Wet (32%)	2,817	2,926	3,154	3,406	3,597	3,841	4,301	4,453	4,228	3,733	3,362	3,252
Above Normal (16%)	2,499	2,578	2,808	3,313	3,515	4,038	4,416	4,417	3,979	3,347	2,975	2,921
Below Normal (13%)	2,826	2,846	2,977	3,299	3,646	3,966	4,164	4,042	3,599	3,010	2,601	2,574
Dry (24%)	2,409	2,431	2,578	2,755	3,168	3,644	3,861	3,774	3,333	2,800	2,539	2,496
Critical (15%)	1,873	1,826	1,911	2,050	2,222	2,460	2,386	2,270	1,861	1,409	1,151	1,086

Revised Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,250	3,252	3,359	3,632	3,911	4,220	4,499	4,552	4,434	3,902	3,563	3,400
20%	3,247	3,252	3,333	3,552	3,771	4,118	4,448	4,552	4,283	3,766	3,379	3,354
30%	3,117	3,191	3,302	3,513	3,674	4,020	4,384	4,532	4,155	3,550	3,183	3,095
40%	2,931	3,015	3,253	3,380	3,569	3,980	4,290	4,364	3,907	3,289	2,969	2,942
50%	2,687	2,782	3,116	3,320	3,492	3,917	4,175	4,238	3,704	3,139	2,777	2,749
60%	2,505	2,583	2,937	3,167	3,356	3,713	4,064	3,961	3,482	2,960	2,646	2,599
70%	2,364	2,479	2,619	2,922	3,252	3,513	3,906	3,729	3,335	2,793	2,536	2,456
80%	2,096	2,142	2,178	2,617	2,973	3,390	3,643	3,536	2,977	2,449	2,139	2,114
90%	1,404	1,374	1,488	2,077	2,347	2,775	2,720	2,950	2,583	1,968	1,590	1,536
Long Term												
Full Simulation Period ^b	2,534	2,582	2,755	3,023	3,287	3,641	3,916	3,907	3,539	3,009	2,677	2,613
Water Year Types^c												
Wet (32%)	2,819	2,925	3,153	3,405	3,597	3,841	4,301	4,453	4,225	3,732	3,362	3,255
Above Normal (16%)	2,513	2,592	2,819	3,326	3,521	4,038	4,415	4,415	3,977	3,347	2,974	2,926
Below Normal (13%)	2,822	2,840	2,972	3,293	3,642	3,963	4,163	4,042	3,599	3,012	2,604	2,576
Dry (24%)	2,411	2,434	2,579	2,756	3,170	3,647	3,866	3,774	3,333	2,804	2,543	2,501
Critical (15%)	1,881	1,835	1,920	2,065	2,234	2,471	2,397	2,275	1,864	1,418	1,162	1,102

Revised Second Basis of Comparison minus Second Basis of Comparison

Statistic	End of Month Storage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	1%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	-1%	0%	1%	0%	0%	0%	0%	0%	0%	1%	0%	0%
70%	1%	0%	-1%	1%	0%	0%	1%	-1%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	-1%	0%	0%	1%	2%	1%	-1%
90%	-1%	2%	-2%	1%	-2%	1%	0%	0%	-1%	-1%	0%	1%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	1%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	1%	1%	0%	0%	0%	0%	1%	1%	1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.1.3 Lake Oroville, End of Month Storage

Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,616	2,550	2,788	2,807	2,948	3,052	3,352	3,538	3,538	3,037	2,854	2,707
20%	2,272	2,304	2,464	2,788	2,838	2,990	3,298	3,538	3,531	2,965	2,590	2,473
30%	1,937	2,035	2,166	2,556	2,788	2,937	3,268	3,474	3,285	2,772	2,415	2,135
40%	1,699	1,784	2,024	2,366	2,788	2,841	3,209	3,278	2,983	2,367	2,000	1,795
50%	1,429	1,445	1,715	2,187	2,579	2,788	3,067	3,028	2,658	2,145	1,795	1,609
60%	1,145	1,101	1,402	1,723	2,140	2,641	2,888	2,792	2,438	1,915	1,601	1,365
70%	1,037	1,001	1,079	1,306	1,871	2,230	2,527	2,480	2,064	1,754	1,422	1,239
80%	998	974	999	1,109	1,544	1,806	1,996	2,050	1,769	1,436	1,232	1,052
90%	913	877	889	1,003	1,200	1,472	1,563	1,575	1,325	1,133	995	917
Long Term												
Full Simulation Period ^b	1,588	1,585	1,742	1,978	2,258	2,474	2,735	2,796	2,571	2,160	1,897	1,725
Water Year Types^c												
Wet (32%)	1,936	1,984	2,354	2,636	2,871	2,942	3,300	3,477	3,402	2,976	2,728	2,569
Above Normal (16%)	1,465	1,523	1,702	2,173	2,648	2,937	3,271	3,357	3,081	2,493	2,087	1,827
Below Normal (13%)	1,823	1,783	1,831	2,037	2,361	2,627	2,875	2,836	2,461	1,930	1,637	1,424
Dry (24%)	1,371	1,324	1,344	1,473	1,764	2,120	2,363	2,357	2,031	1,688	1,427	1,261
Critical (15%)	1,117	1,044	1,041	1,125	1,235	1,406	1,423	1,407	1,219	1,027	911	839

Revised Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,613	2,547	2,788	2,807	2,948	3,052	3,352	3,538	3,538	3,037	2,860	2,729
20%	2,277	2,324	2,490	2,788	2,831	2,990	3,298	3,538	3,532	2,959	2,592	2,458
30%	1,932	1,996	2,165	2,565	2,788	2,937	3,268	3,474	3,274	2,756	2,385	2,112
40%	1,687	1,759	2,023	2,372	2,780	2,844	3,209	3,275	2,945	2,340	1,988	1,789
50%	1,406	1,421	1,705	2,204	2,574	2,788	3,084	3,022	2,634	2,121	1,785	1,601
60%	1,143	1,078	1,383	1,682	2,133	2,621	2,885	2,777	2,418	1,913	1,588	1,376
70%	1,034	1,001	1,047	1,307	1,868	2,209	2,499	2,470	2,053	1,723	1,392	1,228
80%	998	959	985	1,109	1,538	1,789	1,938	2,034	1,805	1,443	1,255	1,097
90%	913	876	851	1,003	1,198	1,471	1,575	1,584	1,335	1,113	994	891
Long Term												
Full Simulation Period ^b	1,584	1,580	1,736	1,972	2,253	2,470	2,732	2,792	2,561	2,152	1,891	1,721
Water Year Types^c												
Wet (32%)	1,940	1,983	2,353	2,633	2,869	2,942	3,300	3,478	3,392	2,969	2,730	2,571
Above Normal (16%)	1,465	1,521	1,697	2,166	2,644	2,939	3,274	3,359	3,079	2,491	2,085	1,823
Below Normal (13%)	1,831	1,796	1,839	2,046	2,376	2,642	2,892	2,844	2,460	1,933	1,635	1,413
Dry (24%)	1,354	1,306	1,327	1,456	1,745	2,101	2,345	2,339	2,012	1,668	1,409	1,248
Critical (15%)	1,101	1,028	1,032	1,119	1,227	1,398	1,415	1,398	1,210	1,018	904	840

Revised Second Basis of Comparison minus Second Basis of Comparison

Statistic	End of Month Storage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%
20%	0%	1%	1%	0%	0%	0%	0%	0%	0%	0%	0%	-1%
30%	0%	-2%	0%	0%	0%	0%	0%	0%	0%	-1%	-1%	-1%
40%	-1%	-1%	0%	0%	0%	0%	0%	0%	-1%	-1%	-1%	0%
50%	-2%	-2%	-1%	1%	0%	0%	1%	0%	-1%	-1%	-1%	-1%
60%	0%	-2%	-1%	-2%	0%	-1%	0%	-1%	-1%	0%	-1%	1%
70%	0%	0%	-3%	0%	0%	-1%	-1%	0%	-1%	-2%	-2%	-1%
80%	0%	-2%	-1%	0%	0%	-1%	-3%	-1%	2%	0%	2%	4%
90%	0%	0%	-4%	0%	0%	0%	1%	1%	1%	-2%	0%	-3%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	1%	0%	0%	1%	1%	0%	0%	0%	0%	0%	-1%
Dry (24%)	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%
Critical (15%)	-1%	-2%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.1.4 Folsom Lake, End of Month Storage

Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	689	567	567	567	567	661	792	967	967	906	792	750
20%	582	561	567	567	567	657	792	967	967	817	684	625
30%	552	528	566	563	559	653	792	967	965	728	638	608
40%	469	499	525	556	555	646	792	967	908	641	569	522
50%	400	430	500	523	537	633	792	959	807	546	468	433
60%	351	391	456	470	498	621	790	858	745	504	442	408
70%	336	356	405	430	457	601	733	761	630	433	387	366
80%	291	333	352	388	437	563	634	654	544	371	325	318
90%	253	259	266	311	392	455	489	471	426	309	244	233
Long Term												
Full Simulation Period ^b	431	424	457	475	494	592	715	823	757	579	503	471
Water Year Types^c												
Wet (32%)	483	470	522	524	515	632	785	951	937	793	688	646
Above Normal (16%)	390	412	467	537	538	640	787	946	857	591	522	485
Below Normal (13%)	506	489	502	514	541	626	761	847	739	475	408	387
Dry (24%)	405	399	423	437	486	585	698	769	664	486	432	408
Critical (15%)	339	317	323	325	369	436	469	482	430	352	288	258

Revised Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	692	567	567	567	567	661	792	967	967	903	792	750
20%	580	558	567	567	567	657	792	967	967	816	685	631
30%	548	520	566	563	559	653	792	967	965	725	634	608
40%	472	498	523	554	555	646	792	967	908	639	567	526
50%	396	429	493	523	541	633	792	955	797	546	461	424
60%	349	394	456	470	498	621	790	858	731	497	438	403
70%	329	353	405	428	457	600	733	760	631	432	386	360
80%	285	337	358	388	432	563	635	655	545	376	329	315
90%	253	260	267	304	392	453	484	471	428	311	244	233
Long Term												
Full Simulation Period ^b	430	422	456	474	494	592	715	823	755	577	502	469
Water Year Types^c												
Wet (32%)	483	469	522	524	515	632	785	951	936	793	687	646
Above Normal (16%)	388	410	465	537	538	640	787	946	851	584	517	479
Below Normal (13%)	505	488	501	514	541	626	762	848	739	476	404	385
Dry (24%)	402	396	421	437	486	585	699	768	662	486	432	407
Critical (15%)	336	315	322	323	367	433	467	479	429	349	290	257

Revised Second Basis of Comparison minus Second Basis of Comparison

Statistic	End of Month Storage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%
30%	-1%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	0%
40%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%
50%	-1%	0%	-1%	0%	1%	0%	0%	0%	-1%	0%	-1%	-2%
60%	-1%	1%	0%	0%	0%	0%	0%	0%	-2%	-2%	-1%	-1%
70%	-2%	-1%	0%	-1%	0%	0%	0%	0%	0%	0%	0%	-2%
80%	-2%	1%	2%	0%	-1%	0%	0%	0%	0%	1%	1%	-1%
90%	0%	0%	0%	-2%	0%	0%	-1%	0%	0%	1%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	-1%	-1%	0%	0%	0%	0%	0%	0%	-1%	-1%	-1%	-1%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	-1%
Dry (24%)	-1%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	-1%	-1%	-1%	-1%	0%	-1%	0%	-1%	0%	-1%	1%	-1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.1.5 New Melones Reservoir, End of Month Storage

Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,801	1,782	1,827	1,875	1,952	2,030	2,017	2,134	2,071	1,977	1,869	1,805
20%	1,657	1,655	1,665	1,690	1,847	1,928	1,884	1,963	1,884	1,830	1,719	1,663
30%	1,575	1,582	1,614	1,627	1,697	1,743	1,751	1,836	1,836	1,743	1,635	1,577
40%	1,366	1,372	1,472	1,556	1,621	1,675	1,649	1,601	1,619	1,510	1,415	1,362
50%	1,200	1,211	1,248	1,348	1,472	1,541	1,484	1,511	1,467	1,357	1,258	1,200
60%	1,089	1,093	1,124	1,209	1,259	1,341	1,373	1,379	1,317	1,224	1,134	1,089
70%	956	989	1,040	1,084	1,099	1,099	1,146	1,179	1,147	1,064	982	940
80%	711	712	730	753	825	932	914	945	903	837	758	712
90%	508	517	515	555	666	664	608	619	697	619	547	507
Long Term												
Full Simulation Period ^b	1,192	1,194	1,226	1,279	1,345	1,397	1,402	1,433	1,420	1,336	1,245	1,194
Water Year Types^c												
Wet (32%)	1,443	1,446	1,502	1,606	1,709	1,794	1,833	1,962	1,994	1,917	1,803	1,731
Above Normal (16%)	1,092	1,116	1,175	1,261	1,360	1,455	1,481	1,543	1,516	1,419	1,321	1,274
Below Normal (13%)	1,364	1,366	1,378	1,397	1,453	1,479	1,461	1,447	1,415	1,322	1,228	1,183
Dry (24%)	1,149	1,143	1,149	1,161	1,191	1,221	1,210	1,176	1,131	1,039	956	912
Critical (15%)	667	663	674	680	696	690	646	585	557	498	449	426

Revised Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,879	1,859	1,935	1,954	1,970	2,030	2,043	2,167	2,141	2,080	1,971	1,911
20%	1,775	1,776	1,788	1,823	1,966	1,979	1,955	1,999	2,045	1,947	1,838	1,781
30%	1,666	1,660	1,703	1,764	1,807	1,896	1,885	1,955	1,912	1,817	1,712	1,661
40%	1,508	1,514	1,596	1,693	1,771	1,801	1,788	1,756	1,711	1,634	1,541	1,496
50%	1,364	1,362	1,396	1,478	1,611	1,671	1,625	1,668	1,621	1,512	1,417	1,360
60%	1,257	1,260	1,320	1,353	1,393	1,474	1,492	1,532	1,474	1,381	1,300	1,249
70%	1,074	1,086	1,146	1,224	1,231	1,230	1,250	1,343	1,299	1,204	1,111	1,055
80%	843	824	852	894	999	1,049	1,078	1,094	1,039	975	902	861
90%	705	711	716	724	802	806	749	817	842	775	722	718
Long Term												
Full Simulation Period ^b	1,316	1,321	1,355	1,411	1,470	1,522	1,522	1,564	1,559	1,470	1,373	1,319
Water Year Types^c												
Wet (32%)	1,534	1,539	1,596	1,700	1,784	1,864	1,901	2,027	2,087	2,001	1,880	1,802
Above Normal (16%)	1,225	1,252	1,315	1,405	1,501	1,594	1,613	1,686	1,664	1,566	1,468	1,420
Below Normal (13%)	1,479	1,484	1,500	1,522	1,576	1,605	1,579	1,581	1,555	1,457	1,359	1,313
Dry (24%)	1,285	1,280	1,287	1,303	1,335	1,369	1,351	1,338	1,291	1,197	1,112	1,067
Critical (15%)	845	843	858	869	887	885	837	789	751	682	617	587

Revised Second Basis of Comparison minus Second Basis of Comparison

Statistic	End of Month Storage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4%	4%	6%	4%	1%	0%	1%	2%	3%	5%	5%	6%
20%	7%	7%	7%	8%	6%	3%	4%	2%	9%	6%	7%	7%
30%	6%	5%	5%	8%	6%	9%	8%	6%	4%	4%	5%	5%
40%	10%	10%	8%	9%	9%	8%	8%	10%	6%	8%	9%	10%
50%	14%	12%	12%	10%	9%	8%	10%	10%	10%	11%	13%	13%
60%	16%	15%	17%	12%	11%	10%	9%	11%	12%	13%	15%	15%
70%	12%	10%	10%	13%	12%	12%	9%	14%	13%	13%	13%	12%
80%	18%	16%	17%	19%	21%	13%	18%	16%	15%	17%	19%	21%
90%	39%	37%	39%	31%	20%	22%	23%	32%	21%	25%	32%	42%
Long Term												
Full Simulation Period ^b	10%	11%	11%	10%	9%	9%	9%	9%	10%	10%	10%	10%
Water Year Types^c												
Wet (32%)	6%	6%	6%	6%	4%	4%	4%	3%	5%	4%	4%	4%
Above Normal (16%)	12%	12%	12%	11%	10%	10%	9%	9%	10%	10%	11%	11%
Below Normal (13%)	8%	9%	9%	9%	8%	9%	8%	9%	10%	10%	11%	11%
Dry (24%)	12%	12%	12%	12%	12%	12%	12%	14%	14%	15%	16%	17%
Critical (15%)	27%	27%	27%	28%	27%	28%	29%	35%	35%	37%	37%	38%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.1.6 Trinity Lake, End of Month Elevation

Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,332	2,332	2,332	2,337	2,345	2,350	2,361	2,364	2,361	2,358	2,353	2,343
20%	2,328	2,331	2,332	2,337	2,345	2,350	2,359	2,360	2,355	2,348	2,338	2,330
30%	2,309	2,310	2,323	2,329	2,343	2,350	2,357	2,353	2,349	2,339	2,327	2,315
40%	2,293	2,298	2,308	2,320	2,333	2,346	2,352	2,347	2,338	2,325	2,309	2,296
50%	2,283	2,283	2,294	2,308	2,318	2,330	2,346	2,338	2,326	2,311	2,296	2,286
60%	2,273	2,276	2,279	2,289	2,306	2,320	2,326	2,324	2,318	2,302	2,288	2,278
70%	2,267	2,266	2,274	2,278	2,291	2,301	2,315	2,311	2,306	2,294	2,279	2,267
80%	2,249	2,250	2,253	2,261	2,269	2,283	2,299	2,297	2,289	2,273	2,261	2,252
90%	2,207	2,208	2,212	2,220	2,232	2,246	2,261	2,252	2,245	2,230	2,215	2,209
Long Term												
Full Simulation Period ^b	2,275	2,277	2,283	2,291	2,303	2,314	2,325	2,322	2,317	2,305	2,291	2,280
Water Year Types^c												
Wet (32%)	2,301	2,305	2,314	2,325	2,339	2,347	2,357	2,358	2,355	2,347	2,338	2,328
Above Normal (16%)	2,270	2,273	2,286	2,303	2,320	2,335	2,347	2,346	2,339	2,329	2,315	2,304
Below Normal (13%)	2,295	2,296	2,298	2,305	2,313	2,320	2,331	2,326	2,318	2,303	2,287	2,274
Dry (24%)	2,266	2,269	2,272	2,274	2,284	2,296	2,309	2,304	2,298	2,284	2,269	2,259
Critical (15%)	2,218	2,216	2,217	2,222	2,229	2,243	2,250	2,246	2,243	2,227	2,204	2,191

Revised Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,332	2,332	2,332	2,337	2,345	2,350	2,361	2,364	2,361	2,358	2,353	2,343
20%	2,328	2,331	2,332	2,337	2,345	2,350	2,359	2,360	2,356	2,348	2,338	2,330
30%	2,309	2,310	2,322	2,329	2,343	2,350	2,357	2,353	2,349	2,339	2,327	2,315
40%	2,293	2,298	2,308	2,320	2,334	2,346	2,352	2,347	2,338	2,325	2,310	2,296
50%	2,282	2,284	2,294	2,308	2,319	2,330	2,346	2,338	2,326	2,311	2,296	2,286
60%	2,273	2,276	2,279	2,289	2,306	2,320	2,326	2,324	2,317	2,302	2,288	2,278
70%	2,266	2,265	2,274	2,277	2,290	2,301	2,315	2,310	2,305	2,294	2,278	2,267
80%	2,248	2,250	2,253	2,261	2,270	2,283	2,298	2,297	2,288	2,273	2,261	2,252
90%	2,207	2,206	2,208	2,219	2,231	2,246	2,262	2,254	2,248	2,233	2,215	2,208
Long Term												
Full Simulation Period ^b	2,275	2,277	2,283	2,291	2,303	2,314	2,325	2,323	2,317	2,305	2,291	2,280
Water Year Types^c												
Wet (32%)	2,301	2,305	2,314	2,325	2,339	2,347	2,357	2,358	2,355	2,347	2,338	2,328
Above Normal (16%)	2,270	2,273	2,286	2,303	2,320	2,335	2,347	2,346	2,339	2,329	2,315	2,304
Below Normal (13%)	2,294	2,296	2,298	2,305	2,313	2,320	2,331	2,326	2,318	2,302	2,286	2,274
Dry (24%)	2,266	2,269	2,272	2,274	2,284	2,296	2,309	2,304	2,298	2,283	2,269	2,259
Critical (15%)	2,221	2,217	2,219	2,223	2,230	2,243	2,251	2,247	2,243	2,228	2,205	2,191

Revised Second Basis of Comparison minus Second Basis of Comparison

Statistic	End of Month Elevation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.1.7 Shasta Lake, End of Month Elevation

Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,017	1,017	1,022	1,033	1,044	1,055	1,065	1,067	1,063	1,044	1,030	1,023
20%	1,017	1,017	1,020	1,030	1,039	1,051	1,063	1,067	1,057	1,039	1,023	1,020
30%	1,012	1,015	1,019	1,028	1,035	1,048	1,061	1,066	1,053	1,030	1,014	1,010
40%	1,003	1,007	1,017	1,023	1,031	1,046	1,058	1,061	1,044	1,019	1,005	1,003
50%	993	995	1,012	1,020	1,027	1,044	1,054	1,056	1,037	1,012	997	995
60%	985	988	1,003	1,013	1,021	1,037	1,050	1,046	1,027	1,004	990	988
70%	975	982	991	1,001	1,017	1,028	1,043	1,039	1,020	997	986	982
80%	961	964	966	989	1,005	1,024	1,034	1,029	1,004	979	963	963
90%	918	913	926	959	978	996	994	1,004	989	955	931	926
Long Term												
Full Simulation Period ^b	979	981	990	1,004	1,016	1,031	1,042	1,041	1,026	1,002	986	983
Water Year Types^c												
Wet (32%)	997	1,002	1,012	1,024	1,032	1,041	1,058	1,063	1,055	1,037	1,022	1,017
Above Normal (16%)	974	978	992	1,019	1,028	1,048	1,062	1,062	1,046	1,021	1,005	1,003
Below Normal (13%)	997	998	1,004	1,019	1,034	1,046	1,053	1,049	1,031	1,006	987	986
Dry (24%)	972	974	982	992	1,012	1,032	1,041	1,038	1,020	997	984	982
Critical (15%)	938	935	941	950	961	977	974	967	943	910	889	884

Revised Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,017	1,017	1,022	1,033	1,044	1,055	1,065	1,067	1,063	1,044	1,030	1,023
20%	1,017	1,017	1,020	1,030	1,039	1,051	1,063	1,067	1,057	1,039	1,022	1,021
30%	1,011	1,014	1,019	1,028	1,035	1,048	1,061	1,066	1,053	1,030	1,014	1,010
40%	1,003	1,007	1,017	1,023	1,031	1,047	1,058	1,060	1,044	1,019	1,005	1,004
50%	992	997	1,011	1,020	1,027	1,044	1,054	1,056	1,037	1,012	996	995
60%	984	988	1,003	1,013	1,021	1,037	1,050	1,046	1,027	1,004	991	989
70%	976	983	989	1,003	1,017	1,028	1,044	1,038	1,021	997	986	982
80%	961	964	966	989	1,005	1,023	1,034	1,029	1,005	981	964	962
90%	917	915	923	960	975	996	994	1,004	988	954	931	927
Long Term												
Full Simulation Period ^b	979	981	990	1,004	1,016	1,031	1,042	1,041	1,026	1,002	986	983
Water Year Types^c												
Wet (32%)	997	1,002	1,012	1,024	1,032	1,041	1,058	1,063	1,055	1,037	1,022	1,017
Above Normal (16%)	975	979	993	1,020	1,028	1,048	1,062	1,062	1,046	1,021	1,005	1,003
Below Normal (13%)	997	998	1,004	1,019	1,033	1,046	1,053	1,049	1,031	1,006	987	986
Dry (24%)	972	974	982	992	1,012	1,032	1,042	1,038	1,020	997	985	983
Critical (15%)	939	936	942	951	962	978	975	968	943	911	890	885

Revised Second Basis of Comparison minus Second Basis of Comparison

Statistic	End of Month Elevation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.1.8 Lake Oroville, End of Month Elevation

Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	837	832	849	850	860	867	887	900	900	866	853	843
20%	811	814	827	849	852	863	884	900	900	861	835	827
30%	776	786	800	833	849	859	882	896	883	848	823	797
40%	752	761	785	820	849	852	877	882	862	820	783	762
50%	719	721	754	802	834	849	868	865	840	798	762	741
60%	685	679	716	754	797	839	856	849	825	774	740	712
70%	672	667	677	704	770	807	831	828	789	758	719	696
80%	666	662	666	680	733	763	782	788	759	720	695	673
90%	651	644	647	667	691	725	736	737	707	683	666	652
Long Term												
Full Simulation Period ^b	730	729	746	771	799	818	838	842	823	788	762	744
Water Year Types^c												
Wet (32%)	768	773	810	837	854	859	884	896	891	861	844	831
Above Normal (16%)	717	723	745	796	838	859	882	888	869	826	790	763
Below Normal (13%)	757	752	757	779	812	834	854	852	823	775	743	719
Dry (24%)	706	701	705	721	755	791	814	813	784	748	718	698
Critical (15%)	677	668	668	680	694	715	716	714	691	664	647	636

Revised Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	837	832	849	850	860	867	887	900	900	866	854	845
20%	811	816	828	849	852	863	884	900	900	860	835	826
30%	776	782	800	834	849	859	882	896	882	847	821	794
40%	751	758	785	820	848	853	877	882	859	818	782	761
50%	717	718	753	804	834	849	869	865	838	795	761	740
60%	684	676	714	750	797	837	855	848	823	774	739	713
70%	671	667	673	704	769	804	829	827	788	754	715	695
80%	666	659	664	680	733	761	776	786	763	721	698	679
90%	651	644	640	667	691	725	737	738	708	681	666	647
Long Term												
Full Simulation Period ^b	729	728	745	771	798	818	838	842	822	787	762	744
Water Year Types^c												
Wet (32%)	768	773	809	836	854	859	884	896	890	861	844	831
Above Normal (16%)	717	723	745	796	838	859	882	888	869	826	790	763
Below Normal (13%)	757	753	758	780	814	836	855	853	823	775	743	717
Dry (24%)	704	698	703	719	753	790	812	812	782	746	716	697
Critical (15%)	675	666	666	680	693	714	716	713	690	662	646	636

Revised Second Basis of Comparison minus Second Basis of Comparison

Statistic	End of Month Elevation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	-1%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	-1%	0%	0%	0%	0%	0%	0%	0%	-1%	0%
80%	0%	0%	0%	0%	0%	0%	-1%	0%	0%	0%	0%	1%
90%	0%	0%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	-1%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.1.9 Folsom Lake, End of Month Elevation

Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	439	424	424	424	424	436	449	467	467	460	449	445
20%	426	424	424	424	424	436	449	467	467	451	439	432
30%	423	419	424	424	423	435	449	467	467	443	433	429
40%	412	416	419	423	423	434	449	467	460	434	425	419
50%	404	407	416	419	421	433	449	465	450	422	412	408
60%	396	402	410	412	416	431	449	455	444	417	409	405
70%	394	397	404	407	411	429	443	446	432	408	402	399
80%	386	393	396	402	408	424	433	435	422	400	392	391
90%	379	380	382	390	403	410	415	412	407	389	377	375
Long Term												
Full Simulation Period ^b	404	404	410	412	415	427	440	451	444	423	413	409
Water Year Types^c												
Wet (32%)	412	412	419	419	418	432	448	465	464	449	438	433
Above Normal (16%)	397	400	410	421	421	433	448	465	456	427	419	414
Below Normal (13%)	415	414	416	417	421	432	446	455	443	410	401	398
Dry (24%)	401	401	405	407	414	427	439	446	435	413	406	403
Critical (15%)	389	386	390	391	397	406	410	411	404	391	378	372

Revised Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	439	424	424	424	424	436	449	467	467	460	449	445
20%	426	423	424	424	424	436	449	467	467	451	439	432
30%	422	418	424	424	423	435	449	467	467	443	433	429
40%	413	416	419	423	423	434	449	467	460	433	424	419
50%	403	407	415	419	421	433	449	465	449	422	411	407
60%	396	403	410	412	416	431	449	455	443	416	408	404
70%	393	397	404	407	411	428	443	446	432	408	402	398
80%	385	394	397	402	408	424	433	435	422	400	393	390
90%	379	381	382	389	403	410	414	412	407	390	377	375
Long Term												
Full Simulation Period ^b	404	404	409	412	415	427	440	451	444	423	413	409
Water Year Types^c												
Wet (32%)	412	412	419	419	418	432	448	465	464	448	437	433
Above Normal (16%)	396	400	410	421	421	433	448	465	455	426	418	413
Below Normal (13%)	415	414	415	417	421	432	446	455	443	410	400	397
Dry (24%)	401	401	405	407	414	427	439	446	435	413	406	403
Critical (15%)	388	386	390	391	396	406	410	411	403	390	378	372

Revised Second Basis of Comparison minus Second Basis of Comparison

Statistic	End of Month Elevation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.1.10 New Melones Reservoir, End of Month Elevation

Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,032	1,031	1,035	1,040	1,048	1,055	1,054	1,064	1,058	1,050	1,039	1,033
20%	1,018	1,018	1,019	1,021	1,037	1,045	1,041	1,049	1,041	1,035	1,024	1,019
30%	1,010	1,010	1,014	1,015	1,022	1,027	1,027	1,036	1,036	1,027	1,016	1,010
40%	988	988	999	1,008	1,014	1,020	1,017	1,012	1,014	1,003	994	987
50%	966	968	972	985	999	1,006	1,001	1,003	999	986	974	966
60%	952	952	956	967	974	984	989	989	981	969	957	952
70%	934	939	945	951	953	953	959	963	959	948	938	932
80%	892	892	896	901	915	931	929	933	927	918	902	892
90%	851	852	852	860	883	883	871	873	889	873	859	850
Long Term												
Full Simulation Period ^b	952	953	957	965	974	981	981	984	982	971	959	953
Water Year Types^c												
Wet (32%)	989	990	997	1,009	1,021	1,030	1,034	1,047	1,050	1,043	1,032	1,025
Above Normal (16%)	941	944	951	966	979	992	995	1,003	1,001	990	978	972
Below Normal (13%)	977	977	979	982	991	994	994	993	991	980	968	962
Dry (24%)	951	950	950	953	957	962	963	960	954	941	929	922
Critical (15%)	866	866	870	872	878	879	871	856	850	835	823	817

Revised Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,040	1,038	1,046	1,048	1,050	1,055	1,056	1,066	1,064	1,059	1,050	1,044
20%	1,030	1,030	1,031	1,035	1,049	1,050	1,048	1,052	1,056	1,047	1,036	1,030
30%	1,019	1,018	1,023	1,029	1,033	1,042	1,041	1,048	1,044	1,034	1,024	1,018
40%	1,003	1,004	1,012	1,022	1,029	1,033	1,031	1,028	1,023	1,016	1,006	1,002
50%	987	987	992	1,000	1,013	1,019	1,015	1,019	1,014	1,003	994	987
60%	974	974	982	986	991	1,000	1,001	1,005	1,000	990	979	972
70%	950	951	959	969	970	970	973	985	979	967	954	947
80%	919	915	921	926	940	946	950	952	945	937	927	922
90%	891	892	893	895	911	912	900	914	919	905	894	894
Long Term												
Full Simulation Period ^b	972	973	977	984	992	998	997	1,001	1,000	990	978	972
Water Year Types^c												
Wet (32%)	1,001	1,002	1,009	1,020	1,029	1,038	1,041	1,053	1,059	1,051	1,039	1,032
Above Normal (16%)	958	962	970	984	996	1,007	1,010	1,019	1,017	1,007	996	990
Below Normal (13%)	993	993	995	998	1,006	1,010	1,007	1,009	1,006	996	984	979
Dry (24%)	971	971	972	974	978	982	981	980	975	964	952	946
Critical (15%)	905	905	908	911	915	916	907	899	892	878	865	859

Revised Second Basis of Comparison minus Second Basis of Comparison

Statistic	End of Month Elevation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1%	1%	1%	1%	0%	0%	0%	0%	1%	1%	1%	1%
20%	1%	1%	1%	1%	1%	0%	1%	0%	1%	1%	1%	1%
30%	1%	1%	1%	1%	1%	1%	1%	1%	1%	1%	1%	1%
40%	2%	2%	1%	1%	1%	1%	1%	2%	1%	1%	1%	1%
50%	2%	2%	2%	1%	1%	1%	1%	2%	2%	2%	2%	2%
60%	2%	2%	3%	2%	2%	2%	1%	2%	2%	2%	2%	2%
70%	2%	1%	1%	2%	2%	2%	1%	2%	2%	2%	2%	2%
80%	3%	3%	3%	3%	3%	2%	2%	2%	2%	2%	3%	3%
90%	5%	5%	5%	4%	3%	3%	3%	5%	3%	4%	4%	5%
Long Term												
Full Simulation Period ^b	2%	2%	2%	2%	2%	2%	2%	2%	2%	2%	2%	2%
Water Year Types^c												
Wet (32%)	1%	1%	1%	1%	1%	1%	1%	1%	1%	1%	1%	1%
Above Normal (16%)	2%	2%	2%	2%	2%	2%	1%	2%	2%	2%	2%	2%
Below Normal (13%)	2%	2%	2%	2%	2%	2%	1%	2%	2%	2%	2%	2%
Dry (24%)	2%	2%	2%	2%	2%	2%	2%	2%	2%	2%	3%	3%
Critical (15%)	4%	5%	4%	4%	4%	4%	4%	5%	5%	5%	5%	5%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.1.11 Sacramento/San Joaquin River Delta Outflow, Monthly Outflow Volume

Second Basis of Comparison

Statistic	Monthly Outflow Volume (TAF)												TOT
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	357	895	4,054	6,567	8,061	5,795	3,950	2,541	1,167	670	268	260	30,938
20%	283	383	2,007	4,470	4,927	4,380	2,580	1,582	679	593	251	240	24,148
30%	264	327	950	2,828	3,382	2,653	1,494	954	588	515	246	234	18,780
40%	251	291	635	1,564	2,894	2,062	1,215	801	556	492	246	227	14,389
50%	246	268	477	1,080	1,904	1,621	855	734	507	475	246	219	9,739
60%	246	268	382	833	1,179	1,104	724	674	485	400	246	181	8,033
70%	246	268	314	673	908	901	597	563	433	307	246	179	6,520
80%	246	268	277	518	698	752	567	535	422	307	232	179	5,882
90%	211	208	277	405	562	601	528	437	377	246	215	179	4,991
Long Term													
Full Simulation Period ^b	286	506	1,408	2,595	3,126	2,682	1,611	1,161	705	458	252	237	15,027
Water Year Types^c													
Wet (32%)	340	791	3,011	5,453	5,779	5,081	3,010	2,178	1,209	605	271	319	28,046
Above Normal (16%)	253	566	1,391	2,845	3,822	3,311	1,615	1,026	562	601	249	224	16,467
Below Normal (13%)	291	433	545	879	2,062	1,078	813	719	533	437	255	206	8,251
Dry (24%)	260	296	439	815	1,269	1,236	879	635	454	310	242	191	7,026
Critical (15%)	240	244	364	670	690	680	525	386	346	248	231	179	4,802

Revised Second Basis of Comparison

Statistic	Monthly Outflow Volume (TAF)												TOT
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	373	895	4,048	6,551	8,106	5,795	3,956	2,541	1,141	670	271	259	30,929
20%	286	384	2,029	4,469	4,884	4,375	2,589	1,579	658	581	247	240	24,158
30%	269	329	947	2,826	3,377	2,686	1,466	952	591	508	246	234	18,772
40%	257	291	635	1,561	2,882	2,060	1,215	790	559	492	246	229	14,349
50%	246	269	464	1,078	1,898	1,614	859	715	512	461	246	221	9,721
60%	246	268	371	829	1,168	1,103	726	675	495	400	246	184	8,015
70%	246	268	312	665	918	899	599	560	439	307	246	179	6,505
80%	246	268	277	501	720	751	565	533	422	307	236	179	5,871
90%	232	208	277	405	596	601	528	437	369	246	215	179	5,025
Long Term													
Full Simulation Period ^b	289	508	1,407	2,590	3,140	2,678	1,609	1,159	704	457	252	238	15,030
Water Year Types^c													
Wet (32%)	345	794	3,009	5,453	5,819	5,073	3,004	2,182	1,199	607	271	321	28,075
Above Normal (16%)	252	566	1,394	2,837	3,821	3,313	1,620	1,021	569	599	250	223	16,464
Below Normal (13%)	294	433	540	878	2,078	1,075	812	715	532	429	254	208	8,248
Dry (24%)	267	297	433	821	1,268	1,232	879	627	455	310	244	191	7,025
Critical (15%)	241	244	367	640	692	680	525	385	346	247	229	179	4,774

Revised Second Basis of Comparison minus Second Basis of Comparison

Statistic	Monthly Outflow Volume (Percent Change)												TOT
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	5%	0%	0%	0%	1%	0%	0%	0%	-2%	0%	1%	-1%	0%
20%	1%	0%	1%	0%	-1%	0%	0%	0%	-3%	-2%	-2%	0%	0%
30%	2%	1%	0%	0%	0%	1%	-2%	0%	0%	-1%	0%	0%	0%
40%	2%	0%	0%	0%	0%	0%	0%	-1%	1%	0%	0%	1%	0%
50%	0%	0%	-3%	0%	0%	0%	0%	-3%	1%	-3%	0%	1%	0%
60%	0%	0%	-3%	0%	-1%	0%	0%	0%	2%	0%	0%	2%	0%
70%	0%	0%	-1%	-1%	1%	0%	0%	0%	1%	0%	0%	0%	0%
80%	0%	0%	0%	-3%	3%	0%	0%	0%	0%	0%	2%	0%	0%
90%	10%	0%	0%	0%	6%	0%	0%	0%	-2%	0%	0%	0%	1%
Long Term													
Full Simulation Period ^b	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c													
Wet (32%)	1%	0%	0%	0%	1%	0%	0%	0%	-1%	0%	0%	1%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	1%	0%	0%	-1%	0%
Below Normal (13%)	1%	0%	-1%	0%	1%	0%	0%	-1%	0%	-2%	0%	1%	0%
Dry (24%)	3%	0%	-1%	1%	0%	0%	0%	-1%	0%	0%	1%	0%	0%
Critical (15%)	1%	0%	1%	-4%	0%	0%	0%	0%	0%	0%	-1%	0%	-1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.1.12 Exports Through Jones and Banks Pumping Plants, Monthly Export Volume

Second Basis of Comparison

Statistic	Monthly Export Volume (TAF)												TOT
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	694	671	739	803	727	703	526	515	555	694	694	671	7,362
20%	680	671	724	769	686	608	503	420	455	694	694	671	6,940
30%	627	652	719	747	668	560	477	387	425	680	694	671	6,751
40%	553	623	718	741	614	542	427	351	412	624	634	669	6,572
50%	489	591	683	730	552	509	390	319	389	551	515	635	6,309
60%	433	513	601	635	519	486	321	281	361	474	446	545	5,942
70%	318	464	553	565	465	461	258	242	320	404	369	420	5,012
80%	273	352	500	499	416	374	188	181	176	300	281	340	4,594
90%	209	288	378	391	335	304	109	80	128	160	161	226	3,470
Long Term													
Full Simulation Period ^b	471	525	612	638	538	489	351	308	352	494	489	528	5,793
Water Year Types^c													
Wet (32%)	549	619	716	724	609	543	476	430	456	632	655	660	7,068
Above Normal (16%)	428	521	641	716	584	570	453	363	415	572	647	651	6,560
Below Normal (13%)	548	595	623	674	497	500	337	304	414	629	517	539	6,176
Dry (24%)	435	475	546	579	518	493	259	228	274	403	325	438	4,971
Critical (15%)	340	345	455	433	406	266	134	121	132	139	203	249	3,222

Revised Second Basis of Comparison

Statistic	Monthly Export Volume (TAF)												TOT
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	694	671	738	803	722	707	530	515	526	694	694	671	7,327
20%	681	671	723	769	684	619	508	417	450	694	694	671	6,944
30%	626	659	719	746	666	563	481	369	429	691	694	671	6,761
40%	551	622	717	738	602	542	433	351	408	609	621	668	6,571
50%	488	590	683	724	552	512	391	314	392	555	529	628	6,266
60%	426	502	609	645	512	489	336	277	353	474	468	549	5,943
70%	327	460	554	562	461	459	264	228	316	390	364	408	5,000
80%	249	349	492	499	393	373	189	169	176	306	281	338	4,572
90%	196	286	382	371	309	301	109	81	128	146	183	228	3,458
Long Term													
Full Simulation Period ^b	467	524	613	638	528	491	355	302	349	494	487	526	5,775
Water Year Types^c													
Wet (32%)	544	620	717	724	587	554	485	428	451	632	653	660	7,055
Above Normal (16%)	419	520	641	719	590	568	455	359	411	574	647	648	6,553
Below Normal (13%)	544	595	629	670	471	498	342	296	413	631	525	543	6,156
Dry (24%)	434	472	550	567	516	491	262	221	273	401	323	431	4,941
Critical (15%)	336	340	444	451	405	264	135	110	132	138	195	249	3,199

Revised Second Basis of Comparison minus Second Basis of Comparison

Statistic	Monthly Export Volume (Percent Change)												TOT
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	0%	0%	0%	0%	-1%	1%	1%	0%	-5%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	2%	1%	-1%	-1%	0%	0%	0%	0%
30%	0%	1%	0%	0%	0%	1%	1%	-5%	1%	2%	0%	0%	0%
40%	0%	0%	0%	0%	-2%	0%	1%	0%	-1%	-2%	-2%	0%	0%
50%	0%	0%	0%	-1%	0%	0%	0%	-1%	1%	3%	-1%	-1%	-1%
60%	-2%	-2%	1%	2%	-1%	1%	5%	-1%	-2%	0%	5%	1%	0%
70%	3%	-1%	0%	-1%	-1%	0%	2%	-6%	-1%	-3%	-1%	-3%	0%
80%	-9%	-1%	-2%	0%	-6%	-1%	1%	-7%	0%	2%	0%	-1%	0%
90%	-6%	-1%	1%	-5%	-8%	-1%	0%	1%	0%	-8%	14%	1%	0%
Long Term													
Full Simulation Period ^b	-1%	0%	0%	0%	-2%	0%	1%	-2%	-1%	0%	0%	0%	0%
Water Year Types^c													
Wet (32%)	-1%	0%	0%	0%	-4%	2%	2%	0%	-1%	0%	0%	0%	0%
Above Normal (16%)	-2%	0%	0%	0%	1%	0%	1%	-1%	-1%	0%	0%	0%	0%
Below Normal (13%)	-1%	0%	1%	-1%	-5%	0%	1%	-2%	0%	0%	1%	1%	0%
Dry (24%)	0%	-1%	1%	-2%	0%	0%	1%	-3%	0%	-1%	-1%	-2%	-1%
Critical (15%)	-1%	-1%	-2%	4%	0%	-1%	1%	-8%	0%	-1%	-4%	0%	-1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.1.13 Trinity River below Lewiston Reservoir, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	373	300	300	1,448	2,106	527	600	4,709	4,626	1,102	450	450
20%	373	300	300	300	300	300	540	4,709	2,526	1,102	450	450
30%	373	300	300	300	300	300	540	4,570	2,526	1,102	450	450
40%	373	300	300	300	300	300	521	4,570	2,526	1,102	450	450
50%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
60%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
70%	373	300	300	300	300	300	460	2,924	783	450	450	450
80%	373	300	300	300	300	300	460	2,924	783	450	450	450
90%	373	300	300	300	300	300	427	1,498	783	450	450	450
Long Term												
Full Simulation Period ^b	367	358	660	739	741	670	557	3,753	2,210	890	450	445
Water Year Types^c												
Wet (32%)	373	504	1,437	1,646	1,300	1,386	639	4,556	3,413	1,136	450	450
Above Normal (16%)	373	300	300	374	801	462	457	4,597	2,948	1,102	450	450
Below Normal (13%)	373	300	300	300	630	303	517	3,585	1,755	924	450	450
Dry (24%)	354	300	300	300	300	300	528	3,250	1,271	678	450	450
Critical (15%)	364	257	300	300	300	300	575	2,092	783	450	450	413

Revised Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	373	300	300	1,448	2,151	387	600	4,709	4,626	1,102	450	450
20%	373	300	300	300	300	300	540	4,709	2,526	1,102	450	450
30%	373	300	300	300	300	300	540	4,570	2,526	1,102	450	450
40%	373	300	300	300	300	300	521	4,570	2,526	1,102	450	450
50%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
60%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
70%	373	300	300	300	300	300	460	2,924	783	450	450	450
80%	373	300	300	300	300	300	460	2,924	783	450	450	450
90%	373	300	300	300	300	300	427	1,498	783	450	450	450
Long Term												
Full Simulation Period ^b	366	361	659	738	747	668	555	3,753	2,210	890	450	445
Water Year Types^c												
Wet (32%)	373	504	1,432	1,645	1,319	1,380	632	4,556	3,413	1,136	450	450
Above Normal (16%)	373	300	300	374	801	462	457	4,597	2,948	1,102	450	450
Below Normal (13%)	373	300	300	300	630	303	517	3,585	1,755	924	450	450
Dry (24%)	354	300	300	300	300	300	528	3,250	1,271	678	450	450
Critical (15%)	357	275	300	300	300	300	575	2,092	783	450	450	413

Revised Second Basis of Comparison minus Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	2%	-26%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	1%	0%	0%	1%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	1%	0%	-1%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	-2%	7%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.1.14 Clear Creek below Whiskeytown, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	200	200	200	200	200	200	200	200	200	85	85	150
20%	200	200	200	200	200	200	200	200	200	85	85	150
30%	200	200	200	200	200	200	200	200	200	85	85	150
40%	200	200	200	200	200	200	200	200	200	85	85	150
50%	200	200	200	200	200	200	200	200	200	85	85	150
60%	200	200	200	200	200	200	200	200	200	85	85	150
70%	200	200	200	200	200	200	200	200	200	85	85	150
80%	200	200	200	200	200	200	200	200	150	85	85	150
90%	150	150	150	150	150	150	150	150	150	85	85	150
Long Term												
Full Simulation Period ^b	185	188	190	225	241	214	191	192	181	85	85	148
Water Year Types^c												
Wet (32%)	200	200	200	309	356	272	200	200	200	85	85	150
Above Normal (16%)	181	182	188	192	196	196	196	200	200	85	85	150
Below Normal (13%)	195	195	195	195	195	195	195	195	191	85	85	150
Dry (24%)	178	184	188	190	190	190	190	190	183	85	85	150
Critical (15%)	163	167	167	167	167	167	167	167	111	85	85	133

Revised Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	200	200	200	200	200	200	200	200	200	85	85	150
20%	200	200	200	200	200	200	200	200	200	85	85	150
30%	200	200	200	200	200	200	200	200	200	85	85	150
40%	200	200	200	200	200	200	200	200	200	85	85	150
50%	200	200	200	200	200	200	200	200	200	85	85	150
60%	200	200	200	200	200	200	200	200	200	85	85	150
70%	200	200	200	200	200	200	200	200	200	85	85	150
80%	200	200	200	200	200	200	200	200	150	85	85	150
90%	150	150	150	150	150	150	150	150	150	85	85	150
Long Term												
Full Simulation Period ^b	185	188	190	225	241	214	191	192	181	85	85	148
Water Year Types^c												
Wet (32%)	200	200	200	309	356	272	200	200	200	85	85	150
Above Normal (16%)	181	182	188	192	196	196	196	200	200	85	85	150
Below Normal (13%)	195	195	195	195	195	195	195	195	191	85	85	150
Dry (24%)	178	184	188	190	190	190	190	190	183	85	85	150
Critical (15%)	163	167	167	167	167	167	167	167	111	85	85	133

Revised Second Basis of Comparison minus Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.1.15 Sacramento River d/s of Keswick Reservoir, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	8,508	7,576	19,509	20,146	30,874	18,571	10,177	10,192	14,534	15,000	12,723	8,971
20%	7,890	6,794	11,462	15,160	21,412	12,718	8,220	9,232	13,041	15,000	11,885	6,409
30%	7,356	5,587	6,088	8,978	13,139	8,359	6,971	8,471	12,242	15,000	11,209	6,029
40%	6,136	5,210	4,329	4,737	5,375	4,500	6,320	7,928	11,433	14,639	10,726	5,666
50%	5,715	4,858	4,000	4,333	4,500	4,500	5,731	7,458	11,014	14,084	10,347	5,475
60%	5,257	4,364	3,949	3,798	3,735	3,668	5,202	7,098	10,374	13,509	9,891	5,246
70%	4,871	4,181	3,674	3,251	3,250	3,250	4,500	6,497	9,974	13,051	9,282	4,637
80%	4,389	4,000	3,275	3,250	3,250	3,250	4,500	6,095	9,209	11,861	8,985	4,312
90%	4,000	3,501	3,250	3,250	3,250	3,250	3,713	5,503	8,402	10,691	8,150	4,147
Long Term												
Full Simulation Period ^b	6,028	5,615	7,660	9,366	11,718	8,569	6,754	7,708	11,203	13,462	10,417	5,836
Water Year Types^c												
Wet (32%)	6,391	6,705	14,039	18,191	20,773	16,037	8,687	8,398	10,243	13,254	11,143	7,306
Above Normal (16%)	5,940	5,801	7,417	9,024	17,709	8,800	6,317	7,789	12,028	14,804	11,351	6,065
Below Normal (13%)	6,491	5,680	4,134	4,805	7,156	5,076	6,127	8,129	12,334	14,533	11,988	5,429
Dry (24%)	6,092	4,768	3,855	4,123	3,591	3,716	5,107	7,240	11,737	13,465	8,939	4,794
Critical (15%)	4,806	4,404	3,675	3,533	3,335	3,431	6,355	6,519	10,465	11,474	8,854	4,513

Revised Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	8,508	7,567	19,509	20,470	31,560	18,571	10,172	10,229	14,458	15,000	12,700	8,243
20%	7,898	6,796	11,485	15,018	21,412	12,718	8,215	9,227	13,000	15,000	11,702	6,412
30%	7,349	5,700	6,189	8,978	12,892	8,359	6,962	8,481	12,266	15,000	11,187	5,953
40%	6,205	5,230	4,374	4,500	5,302	4,500	6,305	8,011	11,426	14,606	10,732	5,680
50%	5,651	4,873	4,016	4,184	4,500	4,500	5,732	7,437	11,089	14,001	10,234	5,500
60%	5,260	4,407	3,976	3,798	3,656	3,872	5,144	7,099	10,345	13,365	9,823	5,180
70%	4,873	4,180	3,680	3,251	3,250	3,250	4,500	6,543	9,975	12,759	9,256	4,650
80%	4,295	4,000	3,274	3,250	3,250	3,250	4,500	6,091	9,205	11,861	9,034	4,318
90%	4,000	3,502	3,250	3,250	3,250	3,250	3,713	5,573	8,400	10,741	8,139	4,013
Long Term												
Full Simulation Period ^b	6,057	5,625	7,681	9,345	11,729	8,578	6,745	7,749	11,210	13,425	10,387	5,801
Water Year Types^c												
Wet (32%)	6,381	6,742	14,046	18,182	20,764	16,037	8,702	8,399	10,291	13,215	11,128	7,264
Above Normal (16%)	5,874	5,793	7,473	8,992	17,811	8,881	6,317	7,819	11,981	14,792	11,359	5,970
Below Normal (13%)	6,540	5,702	4,124	4,784	7,119	5,064	6,094	8,130	12,326	14,507	11,942	5,416
Dry (24%)	6,237	4,756	3,898	4,123	3,573	3,701	5,074	7,334	11,725	13,439	8,903	4,782
Critical (15%)	4,808	4,399	3,682	3,463	3,382	3,440	6,347	6,608	10,486	11,383	8,776	4,501

Revised Second Basis of Comparison minus Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	2%	2%	0%	0%	0%	-1%	0%	0%	-8%
20%	0%	0%	0%	-1%	0%	0%	0%	0%	0%	0%	-2%	0%
30%	0%	2%	2%	0%	-2%	0%	0%	0%	0%	0%	0%	-1%
40%	1%	0%	1%	-5%	-1%	0%	0%	1%	0%	0%	0%	0%
50%	-1%	0%	0%	-3%	0%	0%	0%	0%	1%	-1%	-1%	0%
60%	0%	1%	1%	0%	-2%	6%	-1%	0%	0%	-1%	-1%	-1%
70%	0%	0%	0%	0%	0%	0%	0%	1%	0%	-2%	0%	0%
80%	-2%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	0%
90%	0%	0%	0%	0%	0%	0%	0%	1%	0%	0%	0%	-3%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	1%	0%	0%	0%	-1%
Water Year Types^c												
Wet (32%)	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%
Above Normal (16%)	-1%	0%	1%	0%	1%	1%	0%	0%	0%	0%	0%	-2%
Below Normal (13%)	1%	0%	0%	0%	-1%	0%	-1%	0%	0%	0%	0%	0%
Dry (24%)	2%	0%	1%	0%	-1%	0%	-1%	1%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	-2%	1%	0%	0%	1%	0%	-1%	-1%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.1.16 Feather River d/s of Thermalito, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,000	2,500	5,073	13,890	19,393	14,789	8,389	8,275	7,910	9,420	7,729	5,580
20%	4,000	2,500	3,420	2,988	11,501	11,022	3,686	6,352	6,635	9,054	6,656	5,247
30%	4,000	2,054	2,218	1,700	6,252	7,843	2,757	5,334	6,248	8,621	5,681	4,554
40%	3,974	1,700	1,700	1,700	2,379	5,528	1,853	3,369	5,222	8,022	4,745	3,796
50%	3,439	1,700	1,700	1,700	1,700	2,535	1,254	2,495	4,272	6,164	3,646	2,481
60%	2,492	1,700	1,700	1,700	1,700	1,700	1,000	1,956	3,834	4,837	2,691	1,904
70%	1,846	1,700	1,700	1,200	1,700	1,700	1,000	1,334	3,356	3,641	2,363	1,244
80%	1,700	1,200	1,374	1,200	1,200	1,000	1,000	1,000	2,525	3,030	1,955	1,051
90%	1,200	900	948	900	900	800	968	1,000	1,714	2,044	1,223	1,000
Long Term												
Full Simulation Period ^b	2,883	1,956	3,113	4,812	5,841	6,488	3,136	4,013	4,637	6,050	4,145	3,045
Water Year Types^c												
Wet (32%)	3,068	2,585	5,476	11,696	12,740	13,784	6,587	7,101	4,333	6,920	4,346	3,254
Above Normal (16%)	2,660	1,600	2,519	2,477	5,166	8,173	2,259	3,058	4,823	8,866	6,433	4,449
Below Normal (13%)	3,311	1,913	1,687	1,582	3,161	2,066	1,405	3,388	6,145	7,681	4,260	3,333
Dry (24%)	2,736	1,615	1,966	1,360	1,497	1,321	1,203	2,431	4,961	4,326	3,639	2,574
Critical (15%)	2,577	1,582	1,853	1,139	1,317	1,520	1,414	1,569	3,170	2,495	1,969	1,595

Revised Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,000	2,500	4,835	14,314	19,368	14,789	8,396	8,275	7,856	9,422	7,708	5,582
20%	4,000	2,500	3,418	3,405	11,381	11,022	3,686	6,274	6,941	9,008	6,567	5,294
30%	4,000	2,154	2,155	1,700	6,094	7,843	2,757	5,155	6,254	8,564	5,571	4,549
40%	3,846	1,700	1,700	1,700	2,096	5,528	1,853	3,512	5,303	7,944	4,680	3,736
50%	3,257	1,700	1,700	1,700	1,700	2,556	1,251	2,546	4,170	6,005	3,576	2,541
60%	2,524	1,700	1,700	1,700	1,700	1,700	1,000	2,029	3,830	4,794	2,735	1,630
70%	1,907	1,700	1,700	1,200	1,700	1,700	1,000	1,368	3,414	3,703	2,365	1,194
80%	1,700	1,200	1,233	960	1,200	1,000	1,000	1,000	2,670	3,289	1,809	1,044
90%	1,200	900	947	900	900	800	853	1,000	1,896	2,030	1,206	1,000
Long Term												
Full Simulation Period ^b	2,883	1,975	3,118	4,822	5,809	6,464	3,131	4,034	4,728	6,028	4,104	3,030
Water Year Types^c												
Wet (32%)	3,088	2,647	5,483	11,721	12,717	13,752	6,587	7,095	4,508	6,870	4,216	3,247
Above Normal (16%)	2,619	1,600	2,558	2,517	5,107	8,076	2,259	3,064	4,892	8,869	6,442	4,473
Below Normal (13%)	3,268	1,918	1,782	1,582	3,049	2,066	1,394	3,522	6,283	7,619	4,328	3,469
Dry (24%)	2,761	1,611	1,960	1,360	1,497	1,323	1,191	2,421	4,994	4,330	3,640	2,475
Critical (15%)	2,572	1,582	1,754	1,108	1,317	1,523	1,410	1,609	3,159	2,495	1,898	1,521

Revised Second Basis of Comparison minus Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	-5%	3%	0%	0%	0%	0%	-1%	0%	0%	0%
20%	0%	0%	0%	14%	-1%	0%	0%	-1%	5%	-1%	-1%	1%
30%	0%	5%	-3%	0%	-3%	0%	0%	-3%	0%	-1%	-2%	0%
40%	-3%	0%	0%	0%	-12%	0%	0%	4%	2%	-1%	-1%	-2%
50%	-5%	0%	0%	0%	0%	1%	0%	2%	-2%	-3%	-2%	2%
60%	1%	0%	0%	0%	0%	0%	0%	4%	0%	-1%	2%	-14%
70%	3%	0%	0%	0%	0%	0%	0%	3%	2%	2%	0%	-4%
80%	0%	0%	-10%	-20%	0%	0%	0%	0%	6%	9%	-7%	-1%
90%	0%	0%	0%	0%	0%	0%	-12%	0%	11%	-1%	-1%	0%
Long Term												
Full Simulation Period ^b	0%	1%	0%	0%	-1%	0%	0%	1%	2%	0%	-1%	0%
Water Year Types^c												
Wet (32%)	1%	2%	0%	0%	0%	0%	0%	0%	4%	-1%	-3%	0%
Above Normal (16%)	-2%	0%	2%	2%	-1%	-1%	0%	0%	1%	0%	0%	1%
Below Normal (13%)	-1%	0%	6%	0%	-4%	0%	-1%	4%	2%	-1%	2%	4%
Dry (24%)	1%	0%	0%	0%	0%	0%	-1%	0%	1%	0%	0%	-4%
Critical (15%)	0%	0%	-5%	-3%	0%	0%	0%	3%	0%	0%	-4%	-5%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.1.17 Fremont Weir, Monthly Spills

Second Basis of Comparison

Statistic	Monthly Spills (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	10,543	30,193	44,709	18,331	5,859	100	100	0	0	100
20%	100	100	3,673	10,516	13,894	7,379	4,169	100	100	0	0	100
30%	100	100	1,561	5,231	8,342	5,266	966	100	100	0	0	100
40%	100	100	533	2,826	5,470	3,433	341	100	100	0	0	100
50%	100	100	186	1,630	3,269	2,065	119	100	100	0	0	100
60%	100	100	100	851	2,291	1,101	100	100	100	0	0	100
70%	100	100	100	153	1,008	481	100	100	100	0	0	100
80%	100	100	100	100	184	201	100	100	100	0	0	100
90%	100	100	100	100	100	100	100	100	100	0	0	100
Long Term												
Full Simulation Period ^b	115	384	3,697	9,549	13,200	7,942	2,211	160	104	0	0	100
Water Year Types^c												
Wet (32%)	147	996	9,888	25,442	30,547	18,997	5,602	289	113	0	0	100
Above Normal (16%)	100	100	2,659	6,349	15,114	8,566	1,765	100	100	0	0	100
Below Normal (13%)	100	100	262	1,256	4,057	1,166	292	100	100	0	0	100
Dry (24%)	100	100	342	932	2,032	1,411	411	100	100	0	0	100
Critical (15%)	100	100	149	542	533	408	106	100	100	0	0	100

Revised Second Basis of Comparison

Statistic	Monthly Spills (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	10,536	30,202	45,235	18,332	5,859	100	100	0	0	100
20%	100	100	3,758	10,563	13,794	7,393	4,170	100	100	0	0	100
30%	100	100	1,561	5,232	8,155	5,246	957	100	100	0	0	100
40%	100	100	532	2,826	5,590	3,433	341	100	100	0	0	100
50%	100	100	188	1,638	3,268	2,065	119	100	100	0	0	100
60%	100	100	100	851	2,291	1,093	100	100	100	0	0	100
70%	100	100	100	153	1,142	482	100	100	100	0	0	100
80%	100	100	100	100	184	201	100	100	100	0	0	100
90%	100	100	100	100	100	100	100	100	100	0	0	100
Long Term												
Full Simulation Period ^b	113	386	3,702	9,547	13,182	7,929	2,213	160	104	0	0	100
Water Year Types^c												
Wet (32%)	142	1,002	9,898	25,426	30,534	18,973	5,611	289	113	0	0	100
Above Normal (16%)	100	100	2,664	6,376	15,112	8,541	1,765	100	100	0	0	100
Below Normal (13%)	100	100	262	1,251	3,971	1,167	292	100	100	0	0	100
Dry (24%)	100	100	346	931	2,024	1,405	410	100	100	0	0	100
Critical (15%)	100	100	149	542	536	407	106	100	100	0	0	100

Revised Second Basis of Comparison minus Second Basis of Comparison

Statistic	Monthly Spills (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	1%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	2%	0%	-1%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	-2%	0%	-1%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	2%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	-1%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	13%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	-1%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	-3%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	-2%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.1.18 American River d/s of Nimbus Dam, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,967	3,834	9,336	12,160	14,655	9,754	6,737	7,450	4,650	5,000	3,236	1,837
20%	1,500	3,218	4,325	7,873	10,806	6,805	5,083	4,486	3,799	5,000	2,678	1,604
30%	1,500	2,070	2,528	5,813	7,391	5,044	4,483	3,543	3,623	4,957	2,299	1,533
40%	1,500	1,925	2,000	3,587	5,755	4,172	3,491	2,836	3,223	4,250	1,912	1,533
50%	1,500	1,818	2,000	1,776	3,753	3,039	2,499	2,021	2,835	3,591	1,750	1,533
60%	1,500	1,683	1,936	1,700	2,602	2,015	2,089	1,750	2,245	2,935	1,750	1,533
70%	1,449	1,500	1,701	1,700	1,445	1,747	1,750	1,625	1,832	2,589	1,681	1,493
80%	991	1,136	1,146	1,440	1,264	921	1,162	1,074	1,727	2,373	957	800
90%	800	800	800	819	1,032	800	800	800	1,061	1,327	800	780
Long Term												
Full Simulation Period ^b	1,461	2,386	3,826	5,109	6,030	4,279	3,395	3,077	2,987	3,454	1,899	1,404
Water Year Types^c												
Wet (32%)	1,664	3,300	7,242	10,514	10,615	7,209	5,521	5,541	4,226	3,591	2,597	1,756
Above Normal (16%)	1,274	2,549	3,614	5,670	7,969	6,116	3,572	2,527	2,860	4,782	1,913	1,553
Below Normal (13%)	1,661	2,262	2,660	2,370	5,181	2,187	2,477	1,907	2,881	4,610	1,666	1,236
Dry (24%)	1,329	1,698	1,619	1,587	2,322	2,377	2,222	1,925	2,413	3,028	1,446	1,222
Critical (15%)	1,263	1,492	1,400	1,171	951	1,027	1,391	1,327	1,496	1,368	1,336	935

Revised Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,967	3,951	9,359	12,160	14,655	9,754	6,737	7,450	4,652	5,000	3,200	1,766
20%	1,500	3,208	4,325	7,873	10,804	6,804	5,084	4,486	3,799	5,000	2,779	1,546
30%	1,500	2,078	2,528	5,706	7,391	5,044	4,483	3,543	3,623	4,965	2,299	1,533
40%	1,500	1,925	2,000	3,592	5,756	4,172	3,491	2,851	3,235	4,227	1,968	1,533
50%	1,500	1,827	2,000	1,750	3,739	3,042	2,499	2,060	2,954	3,616	1,750	1,533
60%	1,500	1,683	1,921	1,700	2,602	2,015	2,084	1,750	2,267	2,923	1,750	1,533
70%	1,389	1,438	1,676	1,700	1,445	1,747	1,750	1,614	1,916	2,515	1,659	1,493
80%	994	1,116	1,172	1,359	1,264	1,012	1,146	1,079	1,715	2,373	1,003	800
90%	800	800	800	819	978	800	800	800	1,070	1,377	800	800
Long Term												
Full Simulation Period ^b	1,461	2,384	3,819	5,098	6,026	4,282	3,390	3,085	3,012	3,445	1,905	1,407
Water Year Types^c												
Wet (32%)	1,666	3,308	7,234	10,515	10,615	7,209	5,522	5,541	4,239	3,582	2,611	1,749
Above Normal (16%)	1,269	2,552	3,616	5,637	7,965	6,117	3,572	2,527	2,973	4,780	1,902	1,553
Below Normal (13%)	1,656	2,274	2,654	2,356	5,177	2,187	2,471	1,914	2,895	4,586	1,752	1,205
Dry (24%)	1,321	1,682	1,603	1,572	2,313	2,377	2,209	1,947	2,426	3,001	1,466	1,223
Critical (15%)	1,279	1,469	1,400	1,171	950	1,047	1,383	1,340	1,479	1,395	1,249	1,002

Revised Second Basis of Comparison minus Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	3%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	-4%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	4%	-4%
30%	0%	0%	0%	-2%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	1%	0%	-1%	3%	0%
50%	0%	1%	0%	-1%	0%	0%	0%	2%	4%	1%	0%	0%
60%	0%	0%	-1%	0%	0%	0%	0%	0%	1%	0%	0%	0%
70%	-4%	-4%	-1%	0%	0%	0%	0%	-1%	5%	-3%	-1%	0%
80%	0%	-2%	2%	-6%	0%	10%	-1%	0%	-1%	0%	5%	0%
90%	0%	0%	0%	0%	-5%	0%	0%	0%	1%	4%	0%	3%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	1%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	0%
Above Normal (16%)	0%	0%	0%	-1%	0%	0%	0%	0%	4%	0%	-1%	0%
Below Normal (13%)	0%	1%	0%	-1%	0%	0%	0%	0%	0%	-1%	5%	-3%
Dry (24%)	-1%	-1%	-1%	-1%	0%	0%	-1%	1%	-1%	-1%	1%	0%
Critical (15%)	1%	-1%	0%	0%	0%	2%	-1%	1%	-1%	2%	-7%	7%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.1.19 Sacramento River at Freeport, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	14,535	22,483	54,532	64,835	70,451	63,654	46,241	38,579	21,089	23,075	16,647	15,053
20%	14,097	14,990	34,381	56,263	62,040	51,425	32,543	27,633	18,924	21,676	15,939	14,645
30%	13,025	13,727	22,366	41,579	51,549	41,505	22,929	17,142	17,961	20,420	15,394	14,129
40%	11,580	13,241	18,580	26,629	45,721	29,974	20,054	15,174	16,521	19,429	14,779	13,931
50%	10,818	12,087	15,606	23,009	33,290	24,771	16,394	13,624	15,588	18,340	13,795	13,397
60%	10,029	11,225	14,369	18,466	24,734	20,966	12,916	12,737	14,567	16,653	12,006	11,957
70%	9,019	10,194	12,581	15,005	19,838	18,448	11,708	11,915	13,085	14,599	10,893	9,897
80%	8,009	8,857	10,799	13,486	16,580	15,217	11,229	10,874	12,353	12,878	9,767	8,646
90%	6,709	7,537	9,360	11,871	14,217	11,487	10,200	8,922	11,289	10,339	8,546	7,115
Long Term												
Full Simulation Period ^b	11,135	14,147	23,180	31,236	37,980	31,862	22,179	18,663	16,752	17,326	13,094	12,141
Water Year Types^c												
Wet (32%)	12,828	18,463	38,689	50,375	56,977	48,450	35,060	30,181	20,772	19,106	15,038	14,726
Above Normal (16%)	10,150	15,450	24,122	39,692	47,763	42,758	24,410	18,064	16,533	21,746	15,907	14,192
Below Normal (13%)	12,254	14,318	15,586	19,280	31,808	19,442	14,599	14,690	17,758	20,643	13,951	12,000
Dry (24%)	10,354	10,984	13,633	17,418	23,789	21,475	15,084	12,519	14,646	14,838	10,740	10,387
Critical (15%)	8,809	8,499	11,430	14,601	15,535	12,818	10,626	8,240	10,863	9,787	8,969	7,370

Revised Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	14,551	22,359	54,045	64,879	70,451	63,654	46,240	38,579	20,776	23,195	16,663	15,098
20%	14,090	15,039	34,473	56,266	61,709	51,427	32,544	27,639	18,975	21,635	15,939	14,531
30%	13,193	13,786	22,326	41,578	51,524	41,506	22,932	17,452	18,150	20,277	15,193	14,129
40%	11,535	13,341	18,577	26,629	45,616	29,974	19,982	15,203	16,964	19,565	14,570	13,918
50%	10,865	12,102	15,606	23,009	33,290	24,772	16,394	13,797	15,808	18,216	13,980	13,211
60%	10,117	11,213	14,404	18,460	24,623	20,971	12,918	12,876	14,539	16,370	12,432	12,035
70%	9,064	10,188	12,929	15,002	19,808	18,571	11,683	12,087	13,047	14,608	10,714	9,785
80%	8,007	8,873	10,823	13,487	16,579	15,219	11,109	11,037	12,359	13,049	9,752	8,533
90%	7,029	7,552	9,350	11,866	14,216	11,491	10,200	9,036	11,481	9,999	8,703	7,301
Long Term												
Full Simulation Period ^b	11,166	14,169	23,197	31,223	37,970	31,864	22,160	18,740	16,877	17,261	13,039	12,099
Water Year Types^c												
Wet (32%)	12,847	18,563	38,684	50,414	56,964	48,443	35,068	30,178	21,009	19,004	14,907	14,667
Above Normal (16%)	10,044	15,450	24,213	39,681	47,790	42,769	24,411	18,103	16,671	21,742	15,918	14,124
Below Normal (13%)	12,260	14,350	15,660	19,252	31,672	19,432	14,555	14,839	17,909	20,529	14,052	12,119
Dry (24%)	10,515	10,941	13,654	17,397	23,786	21,469	15,030	12,638	14,681	14,800	10,736	10,279
Critical (15%)	8,820	8,470	11,351	14,500	15,588	12,846	10,613	8,393	10,858	9,733	8,780	7,353

Revised Second Basis of Comparison minus Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	-1%	-1%	0%	0%	0%	0%	0%	-1%	1%	0%	0%
20%	0%	0%	0%	0%	-1%	0%	0%	0%	0%	0%	0%	-1%
30%	1%	0%	0%	0%	0%	0%	0%	2%	1%	-1%	-1%	0%
40%	0%	1%	0%	0%	0%	0%	0%	0%	3%	1%	-1%	0%
50%	0%	0%	0%	0%	0%	0%	0%	1%	1%	-1%	1%	-1%
60%	1%	0%	0%	0%	0%	0%	0%	1%	0%	-2%	4%	1%
70%	1%	0%	3%	0%	0%	1%	0%	1%	0%	0%	-2%	-1%
80%	0%	0%	0%	0%	0%	0%	-1%	1%	0%	1%	0%	-1%
90%	5%	0%	0%	0%	0%	0%	0%	1%	2%	-3%	2%	3%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	1%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	1%	0%	0%	0%	0%	0%	0%	1%	-1%	-1%	0%
Above Normal (16%)	-1%	0%	0%	0%	0%	0%	0%	0%	1%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	1%	1%	-1%	1%	1%
Dry (24%)	2%	0%	0%	0%	0%	0%	0%	1%	0%	0%	0%	-1%
Critical (15%)	0%	0%	-1%	-1%	0%	0%	0%	2%	0%	-1%	-2%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.1.20 Yolo Bypass, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	164	575	15,113	37,297	53,013	25,747	10,346	335	168	48	183	240
20%	162	245	6,239	16,046	22,314	11,069	7,372	178	168	48	55	159
30%	160	146	2,510	8,216	12,519	8,557	2,043	173	168	48	55	159
40%	154	110	802	5,019	10,224	5,190	498	170	168	48	55	159
50%	147	108	495	2,405	5,513	2,987	272	168	167	48	55	159
60%	142	105	259	970	3,258	1,402	229	165	167	48	55	159
70%	132	100	146	470	1,068	754	211	163	166	48	55	157
80%	116	100	109	167	332	225	186	159	164	48	55	155
90%	106	100	100	122	152	149	173	153	162	48	54	152
Long Term												
Full Simulation Period ^b	187	572	5,169	12,745	17,130	10,720	3,653	311	185	48	101	175
Water Year Types^c												
Wet (32%)	231	1,348	13,405	32,933	38,563	25,293	8,874	560	227	48	147	173
Above Normal (16%)	137	344	4,156	9,639	19,777	11,623	3,242	273	166	48	92	165
Below Normal (13%)	246	299	470	1,973	5,998	1,664	546	169	166	48	130	192
Dry (24%)	156	131	583	1,579	3,404	2,190	910	175	167	48	61	170
Critical (15%)	145	124	376	856	905	687	210	167	165	48	55	188

Revised Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	164	575	15,106	37,291	53,011	25,260	10,346	335	168	48	183	240
20%	162	245	6,371	16,098	21,931	11,070	7,372	178	168	48	55	159
30%	160	146	2,509	8,217	12,355	8,556	2,043	173	168	48	55	159
40%	154	110	803	5,020	10,223	5,190	499	170	168	48	55	159
50%	147	108	496	2,405	5,513	2,988	272	168	167	48	55	159
60%	142	105	259	970	3,254	1,402	229	165	167	48	55	159
70%	132	100	146	470	1,202	754	211	163	166	48	55	157
80%	116	100	107	167	345	225	186	159	164	48	55	155
90%	106	100	100	123	129	149	173	153	162	48	54	152
Long Term												
Full Simulation Period ^b	186	574	5,171	12,736	17,111	10,707	3,656	311	185	48	101	175
Water Year Types^c												
Wet (32%)	227	1,354	13,411	32,911	38,549	25,268	8,882	560	227	48	147	173
Above Normal (16%)	137	345	4,161	9,622	19,789	11,595	3,242	273	166	48	92	165
Below Normal (13%)	246	299	470	1,969	5,903	1,665	546	169	166	48	130	192
Dry (24%)	156	131	585	1,582	3,393	2,185	908	175	167	48	61	170
Critical (15%)	145	124	365	857	900	687	210	167	165	48	55	188

Revised Second Basis of Comparison minus Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	-2%	0%	0%	0%	0%	0%	0%
20%	0%	0%	2%	0%	-2%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	-1%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	12%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	-3%	0%	4%	0%	0%	0%	0%	0%	0%	0%
90%	0%	0%	0%	1%	-16%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	-2%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	-2%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	-3%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.1.21 San Joaquin River at Vernalis, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,015	3,156	4,932	11,157	14,594	15,467	14,666	14,360	10,139	5,612	2,740	3,146
20%	2,692	2,843	2,953	4,819	10,200	9,482	10,169	8,291	5,696	2,636	2,600	2,658
30%	2,520	2,663	2,541	3,655	6,300	7,933	8,421	5,676	3,488	1,990	1,897	2,503
40%	2,331	2,500	2,341	2,692	4,268	5,393	7,435	4,617	3,188	1,742	1,676	2,142
50%	2,157	2,386	2,257	2,544	3,420	3,883	6,016	4,043	2,349	1,506	1,500	1,944
60%	1,952	2,244	2,165	2,343	2,774	3,511	4,349	3,276	1,895	1,379	1,415	1,842
70%	1,752	2,141	2,027	2,153	2,443	2,963	3,119	2,891	1,485	1,170	1,321	1,743
80%	1,597	1,984	1,903	1,923	2,174	2,414	2,442	2,362	1,274	1,088	1,211	1,611
90%	1,411	1,793	1,699	1,733	1,945	2,230	1,779	1,890	1,085	941	1,071	1,478
Long Term												
Full Simulation Period ^b	2,241	2,721	3,492	5,136	6,700	7,131	7,255	6,101	4,547	2,625	1,838	2,238
Water Year Types^c												
Wet (23%)	2,497	3,627	6,644	11,506	15,763	16,308	15,374	14,433	12,512	6,641	3,078	3,456
Above Normal (24%)	2,288	2,532	2,757	4,947	6,946	7,415	8,260	5,348	3,525	1,999	1,977	2,352
Below Normal (10%)	2,086	2,397	3,810	3,608	3,723	4,101	5,842	4,213	2,225	1,481	1,457	1,856
Dry (16%)	2,339	2,684	2,347	2,487	2,628	3,304	3,551	2,976	1,714	1,267	1,362	1,789
Critical (27%)	1,974	2,251	1,998	1,927	2,138	2,311	2,031	2,122	1,116	943	1,059	1,485

Revised Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,058	3,088	4,931	11,054	17,256	15,467	14,774	14,101	9,720	6,052	2,996	3,315
20%	2,699	2,813	2,924	4,859	10,259	9,401	10,359	8,202	4,768	2,636	2,599	2,659
30%	2,470	2,631	2,462	3,635	6,228	7,841	8,536	5,452	3,364	1,988	1,896	2,484
40%	2,326	2,448	2,299	2,606	4,252	5,343	7,507	4,488	2,947	1,742	1,675	2,152
50%	2,089	2,342	2,226	2,481	3,420	3,825	6,018	3,916	2,205	1,503	1,499	1,934
60%	1,895	2,218	2,100	2,247	2,681	3,460	4,432	2,913	1,824	1,384	1,415	1,837
70%	1,697	2,100	1,988	2,070	2,379	2,870	3,224	2,493	1,420	1,170	1,322	1,743
80%	1,511	1,954	1,866	1,827	2,153	2,327	2,452	1,994	1,271	1,087	1,211	1,611
90%	1,338	1,753	1,671	1,638	1,931	2,115	1,813	1,564	1,085	941	1,099	1,503
Long Term												
Full Simulation Period ^b	2,200	2,673	3,455	5,082	6,806	7,116	7,330	5,903	4,350	2,668	1,876	2,266
Water Year Types^c												
Wet (23%)	2,472	3,596	6,642	11,484	16,260	16,444	15,398	14,493	12,009	6,823	3,227	3,582
Above Normal (24%)	2,234	2,469	2,712	4,887	6,916	7,376	8,371	5,184	3,310	1,997	1,976	2,348
Below Normal (10%)	2,052	2,330	3,742	3,561	3,837	4,077	5,974	3,968	2,025	1,478	1,455	1,847
Dry (16%)	2,305	2,644	2,306	2,421	2,623	3,227	3,656	2,625	1,661	1,266	1,362	1,783
Critical (27%)	1,926	2,205	1,952	1,854	2,092	2,228	2,079	1,780	1,114	951	1,077	1,490

Revised Second Basis of Comparison minus Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1%	-2%	0%	-1%	18%	0%	1%	-2%	-4%	8%	9%	5%
20%	0%	-1%	-1%	1%	1%	-1%	2%	-1%	-16%	0%	0%	0%
30%	-2%	-1%	-3%	-1%	-1%	-1%	1%	-4%	-4%	0%	0%	-1%
40%	0%	-2%	-2%	-3%	0%	-1%	1%	-3%	-8%	0%	0%	0%
50%	-3%	-2%	-1%	-2%	0%	-1%	0%	-3%	-6%	0%	0%	0%
60%	-3%	-1%	-3%	-4%	-3%	-1%	2%	-11%	-4%	0%	0%	0%
70%	-3%	-2%	-2%	-4%	-3%	-3%	3%	-14%	-4%	0%	0%	0%
80%	-5%	-1%	-2%	-5%	-1%	-4%	0%	-16%	0%	0%	0%	0%
90%	-5%	-2%	-2%	-5%	-1%	-5%	2%	-17%	0%	0%	3%	2%
Long Term												
Full Simulation Period ^b	-2%	-2%	-1%	-1%	2%	0%	1%	-3%	-4%	2%	2%	1%
Water Year Types^c												
Wet (23%)	-1%	-1%	0%	0%	3%	1%	0%	0%	-4%	3%	5%	4%
Above Normal (24%)	-2%	-2%	-2%	-1%	0%	-1%	1%	-3%	-6%	0%	0%	0%
Below Normal (10%)	-2%	-3%	-2%	-1%	3%	-1%	2%	-6%	-9%	0%	0%	0%
Dry (16%)	-1%	-2%	-2%	-3%	0%	-2%	3%	-12%	-3%	0%	0%	0%
Critical (27%)	-2%	-2%	-2%	-4%	-2%	-4%	2%	-16%	0%	1%	2%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.1.22 San Joaquin River at Vernalis, Monthly Salinity

Second Basis of Comparison

Statistic	Monthly Salinity (EC)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	715	631	791	775	938	836	584	539	649	649	635	603
20%	685	599	772	749	882	796	528	527	644	648	603	586
30%	657	576	756	725	831	722	455	486	619	648	580	568
40%	626	563	740	713	789	679	387	431	568	640	571	550
50%	592	546	729	688	693	606	331	374	540	629	556	537
60%	571	527	716	676	624	493	308	358	490	617	542	519
70%	542	512	704	642	468	350	282	346	437	607	526	489
80%	522	487	676	569	321	307	261	294	384	587	451	478
90%	477	456	613	380	281	258	202	192	334	503	433	435
Long Term												
Full Simulation Period ^b	598	537	700	644	636	561	377	392	509	600	540	525
Water Year Types^c												
Wet (23%)	576	511	616	516	362	307	220	229	343	496	419	416
Above Normal (24%)	588	534	713	614	481	417	304	357	474	616	515	506
Below Normal (10%)	605	553	670	654	684	599	319	359	524	610	562	549
Dry (16%)	585	519	731	705	812	682	424	456	577	634	579	557
Critical (27%)	630	566	755	743	892	827	573	537	640	652	635	607

Revised Second Basis of Comparison

Statistic	Monthly Salinity (EC)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	752	643	807	807	948	865	577	597	649	649	622	603
20%	714	611	784	781	911	824	524	572	645	648	603	584
30%	677	584	770	754	840	744	436	528	631	647	580	568
40%	642	572	758	723	790	686	383	493	606	638	571	552
50%	609	555	740	704	693	612	324	395	572	628	557	539
60%	570	538	730	691	631	499	303	363	500	617	543	520
70%	551	522	716	643	469	352	282	346	464	607	526	489
80%	522	495	691	572	316	306	261	294	420	587	451	478
90%	477	467	611	380	261	255	201	192	366	487	410	418
Long Term												
Full Simulation Period ^b	613	547	714	661	642	573	372	419	526	597	533	522
Water Year Types^c												
Wet (23%)	585	518	623	520	357	306	220	229	365	489	405	405
Above Normal (24%)	608	548	728	628	485	421	301	365	494	617	515	506
Below Normal (10%)	618	566	688	673	692	606	313	388	555	611	563	551
Dry (16%)	597	526	742	725	818	698	413	502	593	635	579	559
Critical (27%)	648	577	772	772	909	854	563	594	643	645	623	607

Revised Second Basis of Comparison minus Second Basis of Comparison

Statistic	Monthly Salinity (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	5%	2%	2%	4%	1%	3%	-1%	11%	0%	0%	-2%	0%
20%	4%	2%	2%	4%	3%	4%	-1%	8%	0%	0%	0%	0%
30%	3%	1%	2%	4%	1%	3%	-4%	9%	2%	0%	0%	0%
40%	3%	2%	3%	1%	0%	1%	-1%	14%	7%	0%	0%	0%
50%	3%	2%	1%	2%	0%	1%	-2%	5%	6%	0%	0%	0%
60%	0%	2%	2%	2%	1%	1%	-2%	1%	2%	0%	0%	0%
70%	2%	2%	2%	0%	0%	0%	0%	0%	6%	0%	0%	0%
80%	0%	2%	2%	1%	-2%	0%	0%	0%	9%	0%	0%	0%
90%	0%	2%	0%	0%	-7%	-1%	0%	0%	10%	-3%	-5%	-4%
Long Term												
Full Simulation Period ^b	2%	2%	2%	3%	1%	2%	-1%	7%	3%	-1%	-1%	0%
Water Year Types^c												
Wet (23%)	2%	1%	1%	1%	-1%	0%	0%	0%	6%	-1%	-3%	-3%
Above Normal (24%)	3%	3%	2%	2%	1%	1%	-1%	2%	4%	0%	0%	0%
Below Normal (10%)	2%	2%	3%	3%	1%	1%	-2%	8%	6%	0%	0%	0%
Dry (16%)	2%	1%	2%	3%	1%	2%	-3%	10%	3%	0%	0%	0%
Critical (27%)	3%	2%	2%	4%	2%	3%	-2%	10%	0%	-1%	-2%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.1.23 Stanislaus River below Goodwin, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	350	499	508	508	907	709	1,500	1,500	2,887	360	300	300
20%	350	415	415	415	503	415	1,462	1,500	1,709	306	300	300
30%	331	386	415	408	415	415	1,337	1,434	1,571	300	296	268
40%	286	318	326	318	415	318	991	1,303	845	300	283	268
50%	286	318	318	318	318	318	664	1,303	450	284	283	268
60%	194	247	275	242	318	275	512	1,112	398	268	283	249
70%	194	247	247	242	260	242	461	920	289	268	283	249
80%	173	233	247	242	242	242	424	848	257	265	283	249
90%	164	230	230	200	239	200	378	760	255	265	283	249
Long Term												
Full Simulation Period ^b	291	388	466	584	642	607	884	1,181	1,028	390	347	363
Water Year Types^c												
Wet (23%)	360	612	886	1,060	1,196	1,462	1,488	1,497	2,316	678	580	731
Above Normal (24%)	301	332	376	726	742	523	940	1,225	1,200	354	288	271
Below Normal (10%)	288	373	373	383	418	316	955	1,266	613	272	285	270
Dry (16%)	278	323	331	318	392	262	581	1,094	399	276	283	255
Critical (27%)	230	287	298	275	303	256	464	890	280	283	259	228

Revised Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	350	399	400	400	1,825	999	1,500	1,500	1,502	491	319	300
20%	349	356	358	359	863	400	1,500	1,498	1,243	313	300	300
30%	318	334	340	336	400	344	1,429	1,380	948	300	285	281
40%	260	305	323	318	364	312	1,241	1,134	713	296	283	250
50%	193	246	280	250	339	267	879	855	399	283	283	249
60%	146	217	230	183	304	200	649	725	300	271	283	249
70%	123	207	214	152	239	159	517	612	265	265	283	249
80%	115	202	206	136	176	140	462	507	255	265	283	249
90%	104	188	188	122	133	123	403	439	255	265	283	249
Long Term												
Full Simulation Period ^b	250	340	429	530	748	593	958	984	830	433	386	391
Water Year Types^c												
Wet (23%)	334	581	884	1,038	1,692	1,597	1,511	1,556	1,813	860	729	857
Above Normal (24%)	248	269	331	666	712	484	1,051	1,062	986	352	287	268
Below Normal (10%)	254	306	306	336	532	292	1,087	1,021	414	269	283	261
Dry (16%)	245	282	290	253	387	185	686	743	346	276	283	249
Critical (27%)	181	242	252	203	256	174	511	548	278	291	277	233

Revised Second Basis of Comparison minus Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	-20%	-21%	-21%	101%	41%	0%	0%	-48%	37%	6%	0%
20%	0%	-14%	-14%	-13%	72%	-4%	3%	0%	-27%	2%	0%	0%
30%	-4%	-14%	-18%	-18%	-4%	-17%	7%	-4%	-40%	0%	-4%	5%
40%	-9%	-4%	-1%	0%	-12%	-2%	25%	-13%	-16%	-1%	0%	-7%
50%	-33%	-23%	-12%	-21%	6%	-16%	32%	-34%	-11%	0%	0%	-7%
60%	-25%	-12%	-16%	-24%	-5%	-27%	27%	-35%	-25%	1%	0%	0%
70%	-37%	-16%	-13%	-37%	-8%	-34%	12%	-33%	-9%	-1%	0%	0%
80%	-34%	-13%	-17%	-44%	-27%	-42%	9%	-40%	0%	0%	0%	0%
90%	-37%	-18%	-18%	-39%	-45%	-39%	7%	-42%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	-14%	-12%	-8%	-9%	16%	-2%	8%	-17%	-19%	11%	11%	8%
Water Year Types^c												
Wet (23%)	-7%	-5%	0%	-2%	41%	9%	2%	4%	-22%	27%	26%	17%
Above Normal (24%)	-18%	-19%	-12%	-8%	-4%	-7%	12%	-13%	-18%	0%	-1%	-1%
Below Normal (10%)	-12%	-18%	-18%	-12%	27%	-8%	14%	-19%	-33%	-1%	-1%	-3%
Dry (16%)	-12%	-13%	-12%	-20%	-1%	-29%	18%	-32%	-13%	0%	0%	-2%
Critical (27%)	-21%	-16%	-15%	-26%	-15%	-32%	10%	-38%	-1%	3%	7%	2%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.1.24 Stanislaus River at Mouth, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	662	653	656	688	1,117	1,153	1,804	1,679	3,009	661	569	673
20%	582	548	522	557	694	613	1,608	1,592	2,016	555	485	508
30%	507	492	464	518	562	562	1,489	1,533	1,772	502	461	481
40%	471	459	427	473	512	522	1,040	1,423	1,092	444	445	457
50%	405	421	378	412	484	446	821	1,331	694	412	443	439
60%	377	388	341	364	423	394	637	1,049	572	386	416	431
70%	346	355	329	339	331	361	529	972	402	378	395	396
80%	327	312	311	318	296	295	440	865	352	350	373	373
90%	249	280	269	283	257	233	406	787	312	318	331	316
Long Term												
Full Simulation Period ^b	471	507	549	696	766	756	1,004	1,265	1,231	542	491	545
Water Year Types^c												
Wet (23%)	530	737	980	1,176	1,407	1,704	1,731	1,634	2,632	939	772	985
Above Normal (24%)	494	463	451	840	852	680	1,126	1,323	1,495	535	463	484
Below Normal (10%)	480	503	506	532	589	489	1,057	1,443	807	452	440	443
Dry (16%)	487	437	415	433	484	407	616	1,166	555	377	404	408
Critical (27%)	384	393	360	366	367	309	476	887	334	335	343	338

Revised Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	653	567	590	624	2,437	1,243	1,824	1,680	1,791	932	588	706
20%	577	482	480	506	987	615	1,626	1,588	1,545	564	488	506
30%	491	441	431	462	560	531	1,495	1,515	1,261	499	458	473
40%	424	409	382	434	498	458	1,303	1,285	1,041	443	445	446
50%	377	386	336	392	442	405	1,022	903	726	412	441	439
60%	314	344	312	279	399	311	716	756	418	389	420	431
70%	284	313	291	248	320	277	584	601	375	374	396	397
80%	248	270	270	229	232	226	469	541	347	349	374	370
90%	185	243	204	199	178	146	424	471	312	317	347	320
Long Term												
Full Simulation Period ^b	430	460	512	642	872	741	1,079	1,067	1,034	585	530	573
Water Year Types^c												
Wet (23%)	505	706	978	1,155	1,903	1,839	1,754	1,693	2,130	1,121	921	1,111
Above Normal (24%)	441	400	406	779	822	641	1,237	1,160	1,281	533	461	480
Below Normal (10%)	445	435	438	484	703	466	1,189	1,197	607	449	438	434
Dry (16%)	454	397	375	368	479	330	720	816	502	376	404	402
Critical (27%)	336	347	314	294	320	226	524	544	332	343	361	344

Revised Second Basis of Comparison minus Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-1%	-13%	-10%	-9%	118%	8%	1%	0%	-40%	41%	3%	5%
20%	-1%	-12%	-8%	-9%	42%	0%	1%	0%	-23%	2%	1%	0%
30%	-3%	-10%	-7%	-11%	0%	-6%	0%	-1%	-29%	-1%	-1%	-2%
40%	-10%	-11%	-11%	-8%	-3%	-12%	25%	-10%	-5%	0%	0%	-2%
50%	-7%	-9%	-11%	-5%	-9%	-9%	24%	-32%	5%	0%	0%	0%
60%	-17%	-11%	-8%	-23%	-6%	-21%	12%	-28%	-27%	1%	1%	0%
70%	-18%	-12%	-12%	-27%	-4%	-23%	10%	-38%	-7%	-1%	0%	0%
80%	-24%	-13%	-13%	-28%	-22%	-23%	7%	-37%	-1%	0%	0%	-1%
90%	-26%	-13%	-24%	-30%	-31%	-37%	4%	-40%	0%	0%	5%	1%
Long Term												
Full Simulation Period ^b	-9%	-9%	-7%	-8%	14%	-2%	7%	-16%	-16%	8%	8%	5%
Water Year Types^c												
Wet (23%)	-5%	-4%	0%	-2%	35%	8%	1%	4%	-19%	19%	19%	13%
Above Normal (24%)	-11%	-14%	-10%	-7%	-3%	-6%	10%	-12%	-14%	0%	0%	-1%
Below Normal (10%)	-7%	-13%	-13%	-9%	19%	-5%	13%	-17%	-25%	-1%	0%	-2%
Dry (16%)	-7%	-9%	-10%	-15%	-1%	-19%	17%	-30%	-10%	0%	0%	-1%
Critical (27%)	-13%	-12%	-13%	-20%	-13%	-27%	10%	-39%	-1%	2%	5%	2%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

5C.3.2.1 New Melones Storage

Table 5C.3.2.1.1 New Melones Reservoir, End of Month Storage

No Action Alternative

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,765	1,759	1,823	1,880	1,931	1,980	1,945	2,052	2,075	1,978	1,869	1,805
20%	1,612	1,631	1,647	1,687	1,768	1,799	1,834	1,901	1,876	1,798	1,691	1,633
30%	1,533	1,534	1,556	1,598	1,686	1,729	1,686	1,745	1,786	1,707	1,605	1,556
40%	1,271	1,274	1,432	1,514	1,594	1,618	1,592	1,533	1,539	1,433	1,333	1,273
50%	1,121	1,127	1,154	1,307	1,436	1,535	1,461	1,444	1,392	1,283	1,190	1,156
60%	1,024	1,043	1,080	1,146	1,199	1,273	1,278	1,335	1,277	1,199	1,102	1,054
70%	882	911	986	1,015	1,038	1,057	1,080	1,090	1,087	994	910	868
80%	646	658	684	684	735	808	835	878	872	808	733	693
90%	430	435	440	488	541	569	574	586	630	566	507	473
Long Term												
Full Simulation Period ^b	1,132	1,142	1,180	1,237	1,305	1,348	1,337	1,373	1,381	1,300	1,208	1,159
Water Year Types^c												
Wet (23%)	1,379	1,390	1,454	1,562	1,666	1,724	1,758	1,878	1,968	1,890	1,773	1,703
Above Normal (24%)	1,029	1,060	1,125	1,214	1,317	1,406	1,413	1,484	1,467	1,372	1,277	1,232
Below Normal (10%)	1,294	1,305	1,326	1,351	1,413	1,438	1,390	1,383	1,359	1,268	1,175	1,133
Dry (16%)	1,094	1,094	1,106	1,121	1,156	1,188	1,154	1,132	1,087	997	914	871
Critical (27%)	624	623	638	645	661	656	602	554	526	476	431	408

Revised Alternative 1

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,879	1,859	1,935	1,954	1,970	2,030	2,043	2,167	2,141	2,080	1,971	1,911
20%	1,775	1,776	1,788	1,823	1,966	1,979	1,955	1,999	2,045	1,947	1,838	1,781
30%	1,666	1,660	1,703	1,764	1,807	1,896	1,885	1,955	1,912	1,817	1,712	1,661
40%	1,508	1,514	1,596	1,693	1,771	1,801	1,788	1,756	1,711	1,634	1,541	1,496
50%	1,364	1,362	1,396	1,478	1,611	1,671	1,625	1,668	1,621	1,512	1,417	1,360
60%	1,257	1,260	1,320	1,353	1,393	1,474	1,492	1,532	1,474	1,381	1,300	1,249
70%	1,074	1,086	1,146	1,224	1,231	1,230	1,250	1,343	1,299	1,204	1,111	1,055
80%	843	824	852	894	999	1,049	1,078	1,094	1,039	975	902	861
90%	705	711	716	724	802	806	749	817	842	775	722	718
Long Term												
Full Simulation Period ^b	1,316	1,321	1,355	1,411	1,470	1,522	1,522	1,564	1,559	1,470	1,373	1,319
Water Year Types^c												
Wet (23%)	1,534	1,539	1,596	1,700	1,784	1,864	1,901	2,027	2,087	2,001	1,880	1,802
Above Normal (24%)	1,225	1,252	1,315	1,405	1,501	1,594	1,613	1,686	1,664	1,566	1,468	1,420
Below Normal (10%)	1,479	1,484	1,500	1,522	1,576	1,605	1,579	1,581	1,555	1,457	1,359	1,313
Dry (16%)	1,285	1,280	1,287	1,303	1,335	1,369	1,351	1,338	1,291	1,197	1,112	1,067
Critical (27%)	845	843	858	869	887	885	837	789	751	682	617	587

Revised Alternative 1 minus No Action Alternative

Statistic	End of Month Storage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	6%	6%	6%	4%	2%	3%	5%	6%	3%	5%	5%	6%
20%	10%	9%	9%	8%	11%	10%	7%	5%	9%	8%	9%	9%
30%	9%	8%	9%	10%	7%	10%	12%	12%	7%	6%	7%	7%
40%	19%	19%	11%	12%	11%	11%	12%	15%	11%	14%	16%	18%
50%	22%	21%	21%	13%	12%	9%	11%	15%	16%	18%	19%	18%
60%	23%	21%	22%	18%	16%	16%	17%	15%	15%	15%	18%	18%
70%	22%	19%	16%	21%	18%	16%	16%	23%	19%	21%	22%	21%
80%	31%	25%	25%	31%	36%	30%	29%	25%	19%	21%	23%	24%
90%	64%	63%	63%	48%	48%	42%	30%	39%	34%	37%	42%	52%
Long Term												
Full Simulation Period ^b	16%	16%	15%	14%	13%	13%	14%	14%	13%	13%	14%	14%
Water Year Types^c												
Wet (23%)	11%	11%	10%	9%	7%	8%	8%	8%	6%	6%	6%	6%
Above Normal (24%)	19%	18%	17%	16%	14%	13%	14%	14%	13%	14%	15%	15%
Below Normal (10%)	14%	14%	13%	13%	12%	12%	14%	14%	14%	15%	16%	16%
Dry (16%)	17%	17%	16%	16%	15%	15%	17%	18%	19%	20%	22%	23%
Critical (27%)	36%	35%	35%	35%	34%	35%	39%	43%	43%	43%	43%	44%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.1.2 New Melones Reservoir, End of Month Storage

Revised Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,879	1,859	1,935	1,954	1,970	2,030	2,043	2,167	2,141	2,080	1,971	1,911
20%	1,775	1,776	1,788	1,823	1,966	1,979	1,955	1,999	2,045	1,947	1,838	1,781
30%	1,666	1,660	1,703	1,764	1,807	1,896	1,885	1,955	1,912	1,817	1,712	1,661
40%	1,508	1,514	1,596	1,693	1,771	1,801	1,788	1,756	1,711	1,634	1,541	1,496
50%	1,364	1,362	1,396	1,478	1,611	1,671	1,625	1,668	1,621	1,512	1,417	1,360
60%	1,257	1,260	1,320	1,353	1,393	1,474	1,492	1,532	1,474	1,381	1,300	1,249
70%	1,074	1,086	1,146	1,224	1,231	1,230	1,250	1,343	1,299	1,204	1,111	1,055
80%	843	824	852	894	999	1,049	1,078	1,094	1,039	975	902	861
90%	705	711	716	724	802	806	749	817	842	775	722	718
Long Term												
Full Simulation Period ^b	1,316	1,321	1,355	1,411	1,470	1,522	1,522	1,564	1,559	1,470	1,373	1,319
Water Year Types^c												
Wet (23%)	1,534	1,539	1,596	1,700	1,784	1,864	1,901	2,027	2,087	2,001	1,880	1,802
Above Normal (24%)	1,225	1,252	1,315	1,405	1,501	1,594	1,613	1,686	1,664	1,566	1,468	1,420
Below Normal (10%)	1,479	1,484	1,500	1,522	1,576	1,605	1,579	1,581	1,555	1,457	1,359	1,313
Dry (16%)	1,285	1,280	1,287	1,303	1,335	1,369	1,351	1,338	1,291	1,197	1,112	1,067
Critical (27%)	845	843	858	869	887	885	837	789	751	682	617	587

No Action Alternative

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,765	1,759	1,823	1,880	1,931	1,980	1,945	2,052	2,075	1,978	1,869	1,805
20%	1,612	1,631	1,647	1,687	1,768	1,799	1,834	1,901	1,876	1,798	1,691	1,633
30%	1,533	1,534	1,556	1,598	1,686	1,729	1,686	1,745	1,786	1,707	1,605	1,556
40%	1,271	1,274	1,432	1,514	1,594	1,618	1,592	1,533	1,539	1,433	1,333	1,273
50%	1,121	1,127	1,154	1,307	1,436	1,535	1,461	1,444	1,392	1,283	1,190	1,156
60%	1,024	1,043	1,080	1,146	1,199	1,273	1,278	1,335	1,277	1,199	1,102	1,054
70%	882	911	986	1,015	1,038	1,057	1,080	1,090	1,087	994	910	868
80%	646	658	684	684	735	808	835	878	872	808	733	693
90%	430	435	440	488	541	569	574	586	630	566	507	473
Long Term												
Full Simulation Period ^b	1,132	1,142	1,180	1,237	1,305	1,348	1,337	1,373	1,381	1,300	1,208	1,159
Water Year Types^c												
Wet (23%)	1,379	1,390	1,454	1,562	1,666	1,724	1,758	1,878	1,968	1,890	1,773	1,703
Above Normal (24%)	1,029	1,060	1,125	1,214	1,317	1,406	1,413	1,484	1,467	1,372	1,277	1,232
Below Normal (10%)	1,294	1,305	1,326	1,351	1,413	1,438	1,390	1,383	1,359	1,268	1,175	1,133
Dry (16%)	1,094	1,094	1,106	1,121	1,156	1,188	1,154	1,132	1,087	997	914	871
Critical (27%)	624	623	638	645	661	656	602	554	526	476	431	408

No Action Alternative minus Revised Second Basis of Comparison

Statistic	End of Month Storage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-6%	-5%	-6%	-4%	-2%	-2%	-5%	-5%	-3%	-5%	-5%	-6%
20%	-9%	-8%	-8%	-7%	-10%	-9%	-6%	-5%	-8%	-8%	-8%	-8%
30%	-8%	-8%	-9%	-9%	-7%	-9%	-11%	-11%	-7%	-6%	-6%	-6%
40%	-16%	-16%	-10%	-11%	-10%	-10%	-11%	-13%	-10%	-12%	-14%	-15%
50%	-18%	-17%	-17%	-12%	-11%	-8%	-10%	-13%	-14%	-15%	-16%	-15%
60%	-19%	-17%	-18%	-15%	-14%	-14%	-14%	-13%	-13%	-13%	-15%	-16%
70%	-18%	-16%	-14%	-17%	-16%	-14%	-14%	-19%	-16%	-17%	-18%	-18%
80%	-23%	-20%	-20%	-23%	-26%	-23%	-23%	-20%	-16%	-17%	-19%	-20%
90%	-39%	-39%	-39%	-33%	-33%	-29%	-23%	-28%	-25%	-27%	-30%	-34%
Long Term												
Full Simulation Period ^b	-14%	-14%	-13%	-12%	-11%	-11%	-12%	-12%	-11%	-12%	-12%	-12%
Water Year Types^c												
Wet (23%)	-10%	-10%	-9%	-8%	-7%	-8%	-8%	-7%	-6%	-6%	-6%	-5%
Above Normal (24%)	-16%	-15%	-14%	-14%	-12%	-12%	-12%	-12%	-12%	-12%	-13%	-13%
Below Normal (10%)	-12%	-12%	-12%	-11%	-10%	-10%	-12%	-13%	-13%	-13%	-14%	-14%
Dry (16%)	-15%	-15%	-14%	-14%	-13%	-13%	-15%	-15%	-16%	-17%	-18%	-18%
Critical (27%)	-26%	-26%	-26%	-26%	-25%	-26%	-28%	-30%	-30%	-30%	-30%	-30%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.1.3 New Melones Reservoir, End of Month Storage

Revised Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,879	1,859	1,935	1,954	1,970	2,030	2,043	2,167	2,141	2,080	1,971	1,911
20%	1,775	1,776	1,788	1,823	1,966	1,979	1,955	1,999	2,045	1,947	1,838	1,781
30%	1,666	1,660	1,703	1,764	1,807	1,896	1,885	1,955	1,912	1,817	1,712	1,661
40%	1,508	1,514	1,596	1,693	1,771	1,801	1,788	1,756	1,711	1,634	1,541	1,496
50%	1,364	1,362	1,396	1,478	1,611	1,671	1,625	1,668	1,621	1,512	1,417	1,360
60%	1,257	1,260	1,320	1,353	1,393	1,474	1,492	1,532	1,474	1,381	1,300	1,249
70%	1,074	1,086	1,146	1,224	1,231	1,230	1,250	1,343	1,299	1,204	1,111	1,055
80%	843	824	852	894	999	1,049	1,078	1,094	1,039	975	902	861
90%	705	711	716	724	802	806	749	817	842	775	722	718
Long Term												
Full Simulation Period ^b	1,316	1,321	1,355	1,411	1,470	1,522	1,522	1,564	1,559	1,470	1,373	1,319
Water Year Types^c												
Wet (23%)	1,534	1,539	1,596	1,700	1,784	1,864	1,901	2,027	2,087	2,001	1,880	1,802
Above Normal (24%)	1,225	1,252	1,315	1,405	1,501	1,594	1,613	1,686	1,664	1,566	1,468	1,420
Below Normal (10%)	1,479	1,484	1,500	1,522	1,576	1,605	1,579	1,581	1,555	1,457	1,359	1,313
Dry (16%)	1,285	1,280	1,287	1,303	1,335	1,369	1,351	1,338	1,291	1,197	1,112	1,067
Critical (27%)	845	843	858	869	887	885	837	789	751	682	617	587

Alternative 3

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,967	1,954	1,970	1,970	1,970	2,030	2,062	2,198	2,284	2,209	2,103	2,000
20%	1,901	1,905	1,913	1,911	1,970	2,026	1,988	2,021	2,154	2,055	1,955	1,902
30%	1,729	1,727	1,790	1,857	1,925	1,975	1,910	1,972	1,983	1,877	1,785	1,736
40%	1,582	1,596	1,668	1,775	1,851	1,884	1,838	1,826	1,796	1,697	1,601	1,546
50%	1,427	1,416	1,439	1,556	1,660	1,719	1,674	1,721	1,675	1,561	1,460	1,409
60%	1,308	1,316	1,318	1,366	1,426	1,494	1,488	1,529	1,525	1,432	1,335	1,289
70%	1,049	1,073	1,187	1,210	1,289	1,269	1,265	1,343	1,276	1,180	1,092	1,043
80%	875	862	919	957	1,020	1,099	1,056	1,121	1,071	1,001	938	907
90%	635	646	646	681	779	803	734	731	835	756	682	639
Long Term												
Full Simulation Period ^b	1,347	1,351	1,382	1,436	1,491	1,541	1,534	1,580	1,595	1,506	1,408	1,353
Water Year Types^c												
Wet (23%)	1,562	1,567	1,618	1,720	1,792	1,871	1,906	2,049	2,146	2,057	1,934	1,855
Above Normal (24%)	1,269	1,295	1,356	1,442	1,530	1,620	1,634	1,713	1,720	1,627	1,529	1,481
Below Normal (10%)	1,530	1,536	1,550	1,570	1,620	1,650	1,614	1,617	1,599	1,501	1,403	1,357
Dry (16%)	1,327	1,320	1,326	1,342	1,378	1,409	1,380	1,360	1,319	1,224	1,137	1,091
Critical (27%)	828	824	836	846	866	860	803	751	719	653	593	563

Alternative 3 minus Revised Second Basis of Comparison

Statistic	End of Month Storage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	5%	5%	2%	1%	0%	0%	1%	1%	7%	6%	7%	5%
20%	7%	7%	7%	5%	0%	2%	2%	1%	5%	6%	6%	7%
30%	4%	4%	5%	5%	7%	4%	1%	1%	4%	3%	4%	5%
40%	5%	5%	5%	5%	5%	5%	3%	4%	5%	4%	4%	3%
50%	5%	4%	3%	5%	3%	3%	3%	3%	3%	3%	3%	4%
60%	4%	4%	0%	1%	2%	1%	0%	0%	4%	4%	3%	3%
70%	-2%	-1%	4%	-1%	5%	3%	1%	0%	-2%	-2%	-2%	-1%
80%	4%	5%	8%	7%	2%	5%	-2%	2%	3%	3%	4%	5%
90%	-10%	-9%	-10%	-6%	-3%	0%	-2%	-11%	-1%	-2%	-6%	-11%
Long Term												
Full Simulation Period ^b	2%	2%	2%	2%	1%	1%	1%	1%	2%	2%	3%	3%
Water Year Types^c												
Wet (23%)	2%	2%	1%	1%	0%	0%	0%	1%	3%	3%	3%	3%
Above Normal (24%)	4%	3%	3%	3%	2%	2%	1%	2%	3%	4%	4%	4%
Below Normal (10%)	3%	4%	3%	3%	3%	3%	2%	2%	3%	3%	3%	3%
Dry (16%)	3%	3%	3%	3%	3%	3%	2%	2%	2%	2%	2%	2%
Critical (27%)	-2%	-2%	-3%	-3%	-2%	-3%	-4%	-5%	-4%	-4%	-4%	-4%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.1.4 New Melones Reservoir, End of Month Storage

Revised Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,879	1,859	1,935	1,954	1,970	2,030	2,043	2,167	2,141	2,080	1,971	1,911
20%	1,775	1,776	1,788	1,823	1,966	1,979	1,955	1,999	2,045	1,947	1,838	1,781
30%	1,666	1,660	1,703	1,764	1,807	1,896	1,885	1,955	1,912	1,817	1,712	1,661
40%	1,508	1,514	1,596	1,693	1,771	1,801	1,788	1,756	1,711	1,634	1,541	1,496
50%	1,364	1,362	1,396	1,478	1,611	1,671	1,625	1,668	1,621	1,512	1,417	1,360
60%	1,257	1,260	1,320	1,353	1,393	1,474	1,492	1,532	1,474	1,381	1,300	1,249
70%	1,074	1,086	1,146	1,224	1,231	1,230	1,250	1,343	1,299	1,204	1,111	1,055
80%	843	824	852	894	999	1,049	1,078	1,094	1,039	975	902	861
90%	705	711	716	724	802	806	749	817	842	775	722	718
Long Term												
Full Simulation Period ^b	1,316	1,321	1,355	1,411	1,470	1,522	1,522	1,564	1,559	1,470	1,373	1,319
Water Year Types^c												
Wet (23%)	1,534	1,539	1,596	1,700	1,784	1,864	1,901	2,027	2,087	2,001	1,880	1,802
Above Normal (24%)	1,225	1,252	1,315	1,405	1,501	1,594	1,613	1,686	1,664	1,566	1,468	1,420
Below Normal (10%)	1,479	1,484	1,500	1,522	1,576	1,605	1,579	1,581	1,555	1,457	1,359	1,313
Dry (16%)	1,285	1,280	1,287	1,303	1,335	1,369	1,351	1,338	1,291	1,197	1,112	1,067
Critical (27%)	845	843	858	869	887	885	837	789	751	682	617	587

Alternative 5

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,765	1,759	1,831	1,881	1,949	1,969	1,908	2,012	2,117	2,013	1,900	1,826
20%	1,588	1,587	1,601	1,626	1,782	1,794	1,752	1,844	1,816	1,740	1,631	1,571
30%	1,468	1,459	1,490	1,544	1,630	1,672	1,679	1,693	1,721	1,633	1,531	1,489
40%	1,249	1,252	1,347	1,437	1,522	1,573	1,512	1,494	1,505	1,405	1,297	1,242
50%	1,040	1,058	1,142	1,227	1,437	1,455	1,393	1,357	1,289	1,190	1,100	1,074
60%	976	997	1,023	1,072	1,134	1,161	1,159	1,246	1,218	1,130	1,032	983
70%	766	802	855	907	938	973	1,006	978	991	900	821	783
80%	554	553	620	621	623	697	651	721	761	686	617	587
90%	285	298	299	377	429	449	386	452	492	423	349	308
Long Term												
Full Simulation Period ^b	1,063	1,073	1,112	1,169	1,239	1,284	1,265	1,287	1,299	1,221	1,134	1,086
Water Year Types^c												
Wet (23%)	1,309	1,321	1,388	1,496	1,602	1,668	1,704	1,812	1,906	1,833	1,722	1,653
Above Normal (24%)	983	1,014	1,079	1,168	1,271	1,361	1,363	1,413	1,396	1,302	1,207	1,162
Below Normal (10%)	1,210	1,220	1,242	1,267	1,329	1,354	1,298	1,276	1,254	1,163	1,071	1,028
Dry (16%)	1,018	1,018	1,030	1,045	1,081	1,114	1,066	1,031	990	903	823	781
Critical (27%)	558	559	570	578	597	591	506	449	433	391	355	336

Alternative 5 minus Revised Second Basis of Comparison

Statistic	End of Month Storage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-6%	-5%	-5%	-4%	-1%	-3%	-7%	-7%	-1%	-3%	-4%	-4%
20%	-11%	-11%	-10%	-11%	-9%	-9%	-10%	-8%	-11%	-11%	-11%	-12%
30%	-12%	-12%	-12%	-12%	-10%	-12%	-11%	-13%	-10%	-10%	-11%	-10%
40%	-17%	-17%	-16%	-15%	-14%	-13%	-15%	-15%	-12%	-14%	-16%	-17%
50%	-24%	-22%	-18%	-17%	-11%	-13%	-14%	-19%	-21%	-21%	-22%	-21%
60%	-22%	-21%	-23%	-21%	-19%	-21%	-22%	-19%	-17%	-18%	-21%	-21%
70%	-29%	-26%	-25%	-26%	-24%	-21%	-20%	-27%	-24%	-25%	-26%	-26%
80%	-34%	-33%	-27%	-31%	-38%	-34%	-40%	-34%	-27%	-30%	-32%	-32%
90%	-60%	-58%	-58%	-48%	-47%	-44%	-48%	-45%	-42%	-45%	-52%	-57%
Long Term												
Full Simulation Period ^b	-19%	-19%	-18%	-17%	-16%	-16%	-17%	-18%	-17%	-17%	-17%	-18%
Water Year Types^c												
Wet (23%)	-15%	-14%	-13%	-12%	-10%	-11%	-10%	-11%	-9%	-8%	-8%	-8%
Above Normal (24%)	-20%	-19%	-18%	-17%	-15%	-15%	-16%	-16%	-16%	-17%	-18%	-18%
Below Normal (10%)	-18%	-18%	-17%	-17%	-16%	-16%	-18%	-19%	-19%	-20%	-21%	-22%
Dry (16%)	-21%	-20%	-20%	-20%	-19%	-19%	-21%	-23%	-23%	-25%	-26%	-27%
Critical (27%)	-34%	-34%	-34%	-33%	-33%	-33%	-39%	-43%	-42%	-43%	-43%	-43%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

5C.3.2.2 New Melones Elevation

Table 5C.3.2.2.1 New Melones Reservoir, End of Month Elevation

No Action Alternative

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,029	1,028	1,035	1,040	1,046	1,089	1,047	1,094	1,095	1,085	1,039	1,033
20%	1,013	1,015	1,017	1,021	1,029	1,032	1,036	1,043	1,040	1,032	1,021	1,016
30%	1,006	1,006	1,008	1,012	1,021	1,025	1,021	1,027	1,031	1,023	1,013	1,008
40%	975	976	995	1,004	1,012	1,014	1,011	1,006	1,006	995	983	976
50%	956	957	960	980	996	1,006	998	997	991	977	965	960
60%	943	946	950	959	966	976	976	984	976	966	953	947
70%	925	928	938	942	945	947	950	952	951	939	928	923
80%	879	881	887	887	897	912	918	924	923	912	897	888
90%	835	836	837	847	857	863	864	867	876	863	850	843
Long Term												
Full Simulation Period ^b	944	946	953	962	972	979	976	981	981	969	957	950
Water Year Types^c												
Wet (23%)	983	986	998	1,014	1,027	1,037	1,036	1,054	1,062	1,052	1,038	1,030
Above Normal (24%)	932	937	945	960	974	986	988	997	996	985	973	967
Below Normal (10%)	968	969	972	975	985	988	985	985	983	972	960	955
Dry (16%)	943	943	944	947	951	957	955	953	948	934	922	915
Critical (27%)	856	856	862	864	870	871	860	848	840	828	818	812

Revised Alternative 1

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,158	1,156	1,164	1,166	1,167	1,171	1,172	1,177	1,177	1,175	1,167	1,161
20%	1,147	1,147	1,149	1,152	1,167	1,168	1,166	1,168	1,165	1,165	1,154	1,148
30%	1,136	1,135	1,140	1,146	1,151	1,160	1,159	1,154	1,153	1,152	1,141	1,135
40%	1,119	1,120	1,128	1,139	1,147	1,150	1,149	1,143	1,135	1,132	1,123	1,118
50%	1,060	1,060	1,086	1,116	1,130	1,136	1,131	1,135	1,131	1,120	1,109	1,060
60%	1,046	1,046	1,054	1,059	1,064	1,116	1,117	1,122	1,115	1,062	1,052	1,045
70%	1,022	1,024	1,031	1,042	1,043	1,042	1,045	1,057	1,052	1,039	1,027	1,019
80%	933	930	993	998	1,012	1,019	1,022	1,025	1,017	1,009	999	994
90%	891	892	893	895	911	912	900	914	926	905	894	894
Long Term												
Full Simulation Period ^b	1,050	1,051	1,058	1,069	1,079	1,090	1,090	1,092	1,090	1,077	1,061	1,050
Water Year Types^c												
Wet (23%)	1,098	1,098	1,110	1,128	1,139	1,151	1,155	1,162	1,162	1,165	1,154	1,148
Above Normal (24%)	1,037	1,037	1,049	1,075	1,090	1,105	1,111	1,123	1,127	1,111	1,090	1,081
Below Normal (10%)	1,081	1,085	1,087	1,090	1,105	1,115	1,112	1,113	1,111	1,092	1,081	1,064
Dry (16%)	1,052	1,051	1,053	1,055	1,061	1,075	1,074	1,069	1,060	1,035	1,013	1,000
Critical (27%)	933	933	936	939	943	943	935	927	922	908	889	877

Revised Alternative 1 minus No Action Alternative

Statistic	End of Month Elevation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	13%	12%	12%	12%	12%	8%	12%	8%	8%	8%	12%	12%
20%	13%	13%	13%	13%	13%	13%	13%	12%	12%	13%	13%	13%
30%	13%	13%	13%	13%	13%	13%	13%	12%	12%	13%	13%	13%
40%	15%	15%	13%	13%	13%	13%	14%	14%	13%	14%	14%	15%
50%	11%	11%	13%	14%	13%	13%	13%	14%	14%	15%	15%	10%
60%	11%	11%	11%	10%	10%	14%	14%	14%	14%	10%	10%	10%
70%	11%	10%	10%	11%	10%	10%	10%	11%	11%	11%	11%	10%
80%	6%	6%	12%	13%	13%	12%	11%	11%	10%	11%	11%	12%
90%	7%	7%	7%	6%	6%	6%	4%	5%	6%	5%	5%	6%
Long Term												
Full Simulation Period ^b	11%	11%	11%	11%	11%	11%	12%	11%	11%	11%	11%	11%
Water Year Types^c												
Wet (23%)	12%	11%	11%	11%	11%	11%	11%	10%	9%	11%	11%	11%
Above Normal (24%)	11%	11%	11%	12%	12%	12%	12%	13%	13%	13%	12%	12%
Below Normal (10%)	12%	12%	12%	12%	12%	13%	13%	13%	13%	12%	13%	12%
Dry (16%)	12%	12%	11%	11%	12%	12%	12%	12%	12%	11%	10%	9%
Critical (27%)	9%	9%	9%	9%	8%	8%	9%	9%	10%	10%	9%	8%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.2.2 New Melones Reservoir, End of Month Elevation

Revised Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,158	1,156	1,164	1,166	1,167	1,171	1,172	1,177	1,177	1,175	1,167	1,161
20%	1,147	1,147	1,149	1,152	1,167	1,168	1,166	1,168	1,165	1,165	1,154	1,148
30%	1,136	1,135	1,140	1,146	1,151	1,160	1,159	1,154	1,153	1,152	1,141	1,135
40%	1,119	1,120	1,128	1,139	1,147	1,150	1,149	1,143	1,135	1,132	1,123	1,118
50%	1,060	1,060	1,086	1,116	1,130	1,136	1,131	1,135	1,131	1,120	1,109	1,060
60%	1,046	1,046	1,054	1,059	1,064	1,116	1,117	1,122	1,115	1,062	1,052	1,045
70%	1,022	1,024	1,031	1,042	1,043	1,042	1,045	1,057	1,052	1,039	1,027	1,019
80%	933	930	993	998	1,012	1,019	1,022	1,025	1,017	1,009	999	994
90%	891	892	893	895	911	912	900	914	926	905	894	894
Long Term												
Full Simulation Period ^b	1,050	1,051	1,058	1,069	1,079	1,090	1,090	1,092	1,090	1,077	1,061	1,050
Water Year Types^c												
Wet (23%)	1,098	1,098	1,110	1,128	1,139	1,151	1,155	1,162	1,162	1,165	1,154	1,148
Above Normal (24%)	1,037	1,037	1,049	1,075	1,090	1,105	1,111	1,123	1,127	1,111	1,090	1,081
Below Normal (10%)	1,081	1,085	1,087	1,090	1,105	1,115	1,112	1,113	1,111	1,092	1,081	1,064
Dry (16%)	1,052	1,051	1,053	1,055	1,061	1,075	1,074	1,069	1,060	1,035	1,013	1,000
Critical (27%)	933	933	936	939	943	943	935	927	922	908	889	877

No Action Alternative

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,029	1,028	1,035	1,040	1,046	1,089	1,047	1,094	1,095	1,085	1,039	1,033
20%	1,013	1,015	1,017	1,021	1,029	1,032	1,036	1,043	1,040	1,032	1,021	1,016
30%	1,006	1,006	1,008	1,012	1,021	1,025	1,021	1,027	1,031	1,023	1,013	1,008
40%	975	976	995	1,004	1,012	1,014	1,011	1,006	1,006	995	983	976
50%	956	957	960	980	996	1,006	998	997	991	977	965	960
60%	943	946	950	959	966	976	976	984	976	966	953	947
70%	925	928	938	942	945	947	950	952	951	939	928	923
80%	879	881	887	887	897	912	918	924	923	912	897	888
90%	835	836	837	847	857	863	864	867	876	863	850	843
Long Term												
Full Simulation Period ^b	944	946	953	962	972	979	976	981	981	969	957	950
Water Year Types^c												
Wet (23%)	983	986	998	1,014	1,027	1,037	1,036	1,054	1,062	1,052	1,038	1,030
Above Normal (24%)	932	937	945	960	974	986	988	997	996	985	973	967
Below Normal (10%)	968	969	972	975	985	988	985	985	983	972	960	955
Dry (16%)	943	943	944	947	951	957	955	953	948	934	922	915
Critical (27%)	856	856	862	864	870	871	860	848	840	828	818	812

No Action Alternative minus Revised Second Basis of Comparison

Statistic	End of Month Elevation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-11%	-11%	-11%	-11%	-10%	-7%	-11%	-7%	-7%	-8%	-11%	-11%
20%	-12%	-12%	-11%	-11%	-12%	-12%	-11%	-11%	-11%	-11%	-11%	-12%
30%	-11%	-11%	-12%	-12%	-11%	-12%	-12%	-11%	-11%	-11%	-11%	-11%
40%	-13%	-13%	-12%	-12%	-12%	-12%	-12%	-12%	-11%	-12%	-12%	-13%
50%	-10%	-10%	-12%	-12%	-12%	-11%	-12%	-12%	-12%	-13%	-13%	-9%
60%	-10%	-10%	-10%	-9%	-9%	-13%	-13%	-12%	-12%	-9%	-9%	-9%
70%	-10%	-9%	-9%	-10%	-9%	-9%	-9%	-10%	-10%	-10%	-10%	-9%
80%	-6%	-5%	-11%	-11%	-11%	-11%	-10%	-10%	-9%	-10%	-10%	-11%
90%	-6%	-6%	-6%	-5%	-6%	-5%	-4%	-5%	-5%	-5%	-5%	-6%
Long Term												
Full Simulation Period ^b	-10%	-10%	-10%	-10%	-10%	-10%	-10%	-10%	-10%	-10%	-10%	-10%
Water Year Types^c												
Wet (23%)	-10%	-10%	-10%	-10%	-10%	-10%	-10%	-9%	-9%	-10%	-10%	-10%
Above Normal (24%)	-10%	-10%	-10%	-11%	-11%	-11%	-11%	-11%	-12%	-11%	-11%	-11%
Below Normal (10%)	-10%	-11%	-11%	-11%	-11%	-11%	-11%	-12%	-11%	-11%	-11%	-10%
Dry (16%)	-10%	-10%	-10%	-10%	-10%	-11%	-11%	-11%	-10%	-10%	-9%	-9%
Critical (27%)	-8%	-8%	-8%	-8%	-8%	-8%	-8%	-9%	-9%	-9%	-8%	-7%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.2.3 New Melones Reservoir, End of Month Elevation

Revised Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,158	1,156	1,164	1,166	1,167	1,171	1,172	1,177	1,177	1,175	1,167	1,161
20%	1,147	1,147	1,149	1,152	1,167	1,168	1,166	1,168	1,165	1,165	1,154	1,148
30%	1,136	1,135	1,140	1,146	1,151	1,160	1,159	1,154	1,153	1,152	1,141	1,135
40%	1,119	1,120	1,128	1,139	1,147	1,150	1,149	1,143	1,135	1,132	1,123	1,118
50%	1,060	1,060	1,086	1,116	1,130	1,136	1,131	1,135	1,131	1,120	1,109	1,060
60%	1,046	1,046	1,054	1,059	1,064	1,116	1,117	1,122	1,115	1,062	1,052	1,045
70%	1,022	1,024	1,031	1,042	1,043	1,042	1,045	1,057	1,052	1,039	1,027	1,019
80%	933	930	993	998	1,012	1,019	1,022	1,025	1,017	1,009	999	994
90%	891	892	893	895	911	912	900	914	926	905	894	894
Long Term												
Full Simulation Period ^b	1,050	1,051	1,058	1,069	1,079	1,090	1,090	1,092	1,090	1,077	1,061	1,050
Water Year Types^c												
Wet (23%)	1,098	1,098	1,110	1,128	1,139	1,151	1,155	1,162	1,162	1,165	1,154	1,148
Above Normal (24%)	1,037	1,037	1,049	1,075	1,090	1,105	1,111	1,123	1,127	1,111	1,090	1,081
Below Normal (10%)	1,081	1,085	1,087	1,090	1,105	1,115	1,112	1,113	1,111	1,092	1,081	1,064
Dry (16%)	1,052	1,051	1,053	1,055	1,061	1,075	1,074	1,069	1,060	1,035	1,013	1,000
Critical (27%)	933	933	936	939	943	943	935	927	922	908	889	877

Alternative 3

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,167	1,166	1,167	1,167	1,167	1,171	1,174	1,182	1,180	1,184	1,176	1,169
20%	1,160	1,161	1,162	1,161	1,167	1,171	1,168	1,170	1,168	1,173	1,166	1,161
30%	1,142	1,142	1,149	1,156	1,163	1,168	1,161	1,159	1,149	1,158	1,148	1,143
40%	1,127	1,128	1,136	1,147	1,155	1,159	1,154	1,150	1,137	1,139	1,129	1,123
50%	1,111	1,109	1,112	1,124	1,135	1,141	1,137	1,136	1,135	1,125	1,114	1,109
60%	1,053	1,054	1,054	1,060	1,111	1,118	1,117	1,121	1,121	1,111	1,056	1,050
70%	1,019	1,022	1,037	1,040	1,050	1,048	1,047	1,057	1,049	1,036	1,024	1,018
80%	996	994	1,002	1,007	1,015	1,025	1,020	1,028	1,022	1,012	1,004	1,000
90%	877	879	879	886	906	911	897	896	925	901	886	878
Long Term												
Full Simulation Period ^b	1,056	1,057	1,061	1,070	1,083	1,091	1,090	1,092	1,089	1,082	1,065	1,056
Water Year Types^c												
Wet (23%)	1,101	1,102	1,111	1,125	1,140	1,152	1,155	1,164	1,157	1,169	1,159	1,153
Above Normal (24%)	1,051	1,058	1,065	1,082	1,096	1,107	1,113	1,125	1,132	1,119	1,096	1,088
Below Normal (10%)	1,093	1,094	1,092	1,094	1,109	1,116	1,110	1,121	1,119	1,101	1,079	1,073
Dry (16%)	1,055	1,054	1,055	1,062	1,072	1,079	1,077	1,065	1,061	1,041	1,026	1,011
Critical (27%)	927	927	930	932	943	937	927	917	916	900	882	870

Alternative 3 minus Revised Second Basis of Comparison

Statistic	End of Month Elevation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1%	1%	0%	0%	0%	0%	0%	0%	0%	1%	1%	1%
20%	1%	1%	1%	1%	0%	0%	0%	0%	0%	1%	1%	1%
30%	1%	1%	1%	1%	1%	1%	0%	0%	0%	1%	1%	1%
40%	1%	1%	1%	1%	1%	1%	0%	1%	0%	1%	1%	0%
50%	5%	5%	2%	1%	0%	0%	0%	0%	0%	0%	0%	5%
60%	1%	1%	0%	0%	4%	0%	0%	0%	0%	5%	0%	1%
70%	0%	0%	1%	0%	1%	1%	0%	0%	0%	0%	0%	0%
80%	7%	7%	1%	1%	0%	1%	0%	0%	0%	0%	0%	1%
90%	-2%	-1%	-2%	-1%	0%	0%	0%	-2%	0%	0%	-1%	-2%
Long Term												
Full Simulation Period ^b	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%
Water Year Types^c												
Wet (23%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (24%)	1%	2%	2%	1%	1%	0%	0%	0%	0%	1%	1%	1%
Below Normal (10%)	1%	1%	0%	0%	0%	0%	1%	1%	1%	0%	0%	1%
Dry (16%)	0%	0%	0%	1%	1%	0%	0%	0%	0%	1%	1%	1%
Critical (27%)	-1%	-1%	-1%	-1%	0%	-1%	-1%	-1%	-1%	-1%	-1%	-1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.2.4 New Melones Reservoir, End of Month Elevation

Revised Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,158	1,156	1,164	1,166	1,167	1,171	1,172	1,177	1,177	1,175	1,167	1,161
20%	1,147	1,147	1,149	1,152	1,167	1,168	1,166	1,168	1,165	1,165	1,154	1,148
30%	1,136	1,135	1,140	1,146	1,151	1,160	1,159	1,154	1,153	1,152	1,141	1,135
40%	1,119	1,120	1,128	1,139	1,147	1,150	1,149	1,143	1,135	1,132	1,123	1,118
50%	1,060	1,060	1,086	1,116	1,130	1,136	1,131	1,135	1,131	1,120	1,109	1,060
60%	1,046	1,046	1,054	1,059	1,064	1,116	1,117	1,122	1,115	1,062	1,052	1,045
70%	1,022	1,024	1,031	1,042	1,043	1,042	1,045	1,057	1,052	1,039	1,027	1,019
80%	933	930	993	998	1,012	1,019	1,022	1,025	1,017	1,009	999	994
90%	891	892	893	895	911	912	900	914	926	905	894	894
Long Term												
Full Simulation Period ^b	1,050	1,051	1,058	1,069	1,079	1,090	1,090	1,092	1,090	1,077	1,061	1,050
Water Year Types^c												
Wet (23%)	1,098	1,098	1,110	1,128	1,139	1,151	1,155	1,162	1,162	1,165	1,154	1,148
Above Normal (24%)	1,037	1,037	1,049	1,075	1,090	1,105	1,111	1,123	1,127	1,111	1,090	1,081
Below Normal (10%)	1,081	1,085	1,087	1,090	1,105	1,115	1,112	1,113	1,111	1,092	1,081	1,064
Dry (16%)	1,052	1,051	1,053	1,055	1,061	1,075	1,074	1,069	1,060	1,035	1,013	1,000
Critical (27%)	933	933	936	939	943	943	935	927	922	908	889	877

Alternative 5

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,029	1,028	1,036	1,041	1,047	1,049	1,043	1,053	1,062	1,053	1,043	1,035
20%	1,011	1,011	1,012	1,015	1,031	1,032	1,028	1,037	1,034	1,026	1,015	1,009
30%	999	998	1,001	1,007	1,015	1,019	1,020	1,022	1,024	1,016	1,005	1,001
40%	973	973	985	996	1,004	1,010	1,003	1,002	1,003	992	979	972
50%	945	948	959	970	996	998	991	987	978	965	953	950
60%	937	940	943	949	957	961	961	972	968	957	944	938
70%	904	911	921	928	932	936	941	937	939	927	915	907
80%	860	860	874	874	874	889	880	894	902	887	873	867
90%	803	807	808	824	834	838	826	839	847	833	818	810
Long Term												
Full Simulation Period ^b	931	933	939	947	957	964	961	962	963	952	941	934
Water Year Types^c												
Wet (23%)	969	971	980	995	1,007	1,016	1,020	1,031	1,040	1,033	1,022	1,015
Above Normal (24%)	924	930	939	954	968	980	982	988	987	975	963	958
Below Normal (10%)	954	956	959	962	973	977	972	970	968	957	944	938
Dry (16%)	930	930	932	934	939	945	940	936	931	918	905	898
Critical (27%)	837	838	842	845	853	855	834	818	815	804	796	791

Alternative 5 minus Revised Second Basis of Comparison

Statistic	End of Month Elevation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-11%	-11%	-11%	-11%	-10%	-10%	-11%	-11%	-10%	-10%	-11%	-11%
20%	-12%	-12%	-12%	-12%	-12%	-12%	-12%	-11%	-11%	-12%	-12%	-12%
30%	-12%	-12%	-12%	-12%	-12%	-12%	-12%	-11%	-11%	-12%	-12%	-12%
40%	-13%	-13%	-13%	-13%	-12%	-12%	-13%	-12%	-12%	-12%	-13%	-13%
50%	-11%	-11%	-12%	-13%	-12%	-12%	-12%	-13%	-14%	-14%	-14%	-10%
60%	-10%	-10%	-11%	-10%	-10%	-14%	-14%	-13%	-13%	-10%	-10%	-10%
70%	-12%	-11%	-11%	-11%	-11%	-10%	-10%	-11%	-11%	-11%	-11%	-11%
80%	-8%	-8%	-12%	-12%	-14%	-13%	-14%	-13%	-11%	-12%	-13%	-13%
90%	-10%	-9%	-10%	-8%	-8%	-8%	-8%	-8%	-8%	-8%	-9%	-9%
Long Term												
Full Simulation Period ^b	-11%	-11%	-11%	-11%	-11%	-12%	-12%	-12%	-12%	-12%	-11%	-11%
Water Year Types^c												
Wet (23%)	-12%	-12%	-12%	-12%	-12%	-12%	-12%	-11%	-10%	-11%	-11%	-12%
Above Normal (24%)	-11%	-10%	-10%	-11%	-11%	-11%	-12%	-12%	-12%	-12%	-12%	-11%
Below Normal (10%)	-12%	-12%	-12%	-12%	-12%	-12%	-13%	-13%	-13%	-12%	-13%	-12%
Dry (16%)	-12%	-12%	-11%	-11%	-11%	-12%	-12%	-12%	-12%	-11%	-11%	-10%
Critical (27%)	-10%	-10%	-10%	-10%	-10%	-9%	-11%	-12%	-12%	-11%	-10%	-10%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

5C.3.2.3 Stanislaus River below Goodwin Dam Flow

Table 5C.3.2.3.1 Stanislaus River below Goodwin, Monthly Flow

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	837	290	306	358	897	1,648	1,633	1,929	1,103	429	390	390
20%	797	200	218	232	409	1,521	1,553	1,555	1,090	310	300	300
30%	774	200	200	232	290	440	1,553	1,296	940	300	284	250
40%	774	200	200	226	236	200	1,400	1,242	855	300	283	250
50%	774	200	200	226	236	200	1,400	1,242	363	271	283	250
60%	636	200	200	219	229	200	812	918	363	265	283	249
70%	636	200	200	219	229	200	767	705	297	265	283	249
80%	578	200	200	214	221	200	767	631	261	265	283	249
90%	577	200	200	213	215	200	505	546	255	265	283	249
Long Term												
Full Simulation Period ^b	723	278	365	518	595	754	1,158	1,123	680	394	361	351
Water Year Types^c												
Wet (23%)	781	499	787	999	1,201	2,016	1,536	1,691	1,140	715	639	692
Above Normal (24%)	714	216	282	663	676	645	1,224	1,146	962	353	292	267
Below Normal (10%)	740	225	225	282	346	365	1,454	1,201	476	269	285	256
Dry (16%)	707	208	216	234	313	200	1,030	930	374	275	277	245
Critical (27%)	683	205	215	227	255	234	741	699	281	269	262	231

Revised Alternative 1

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	350	399	400	400	1,825	999	1,500	1,500	1,502	491	319	300
20%	349	356	358	359	863	400	1,500	1,498	1,243	313	300	300
30%	318	334	340	336	400	344	1,429	1,380	948	300	285	281
40%	260	305	323	318	364	312	1,241	1,134	713	296	283	250
50%	193	246	280	250	339	267	879	855	399	283	283	249
60%	146	217	230	183	304	200	649	725	300	271	283	249
70%	123	207	214	152	239	159	517	612	265	265	283	249
80%	115	202	206	136	176	140	462	507	255	265	283	249
90%	104	188	188	122	133	123	403	439	255	265	283	249
Long Term												
Full Simulation Period ^b	250	340	429	530	748	593	958	984	830	433	386	391
Water Year Types^c												
Wet (23%)	334	581	884	1,038	1,692	1,597	1,511	1,556	1,813	860	729	857
Above Normal (24%)	248	269	331	666	712	484	1,051	1,062	986	352	287	268
Below Normal (10%)	254	306	306	336	532	292	1,087	1,021	414	269	283	261
Dry (16%)	245	282	290	253	387	185	686	743	346	276	283	249
Critical (27%)	181	242	252	203	256	174	511	548	278	291	277	233

Revised Alternative 1 minus No Action Alternative

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-58%	38%	31%	12%	103%	-39%	-8%	-22%	36%	14%	-18%	-23%
20%	-56%	78%	64%	55%	111%	-74%	-3%	-4%	14%	1%	0%	0%
30%	-59%	67%	70%	44%	38%	-22%	-8%	7%	1%	0%	0%	12%
40%	-66%	53%	61%	41%	54%	56%	-11%	-9%	-17%	-1%	0%	0%
50%	-75%	23%	40%	11%	44%	34%	-37%	-31%	10%	4%	0%	-1%
60%	-77%	9%	15%	-16%	33%	0%	-20%	-21%	-17%	2%	0%	0%
70%	-81%	3%	7%	-31%	5%	-21%	-33%	-13%	-11%	0%	0%	0%
80%	-80%	1%	3%	-36%	-21%	-30%	-40%	-20%	-2%	0%	0%	0%
90%	-82%	-6%	-6%	-43%	-38%	-39%	-20%	-20%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	-65%	22%	18%	2%	26%	-21%	-17%	-12%	22%	10%	7%	11%
Water Year Types^c												
Wet (23%)	-57%	17%	12%	4%	41%	-21%	-2%	-8%	59%	20%	14%	24%
Above Normal (24%)	-65%	25%	17%	0%	5%	-25%	-14%	-7%	2%	0%	-2%	0%
Below Normal (10%)	-66%	36%	36%	19%	54%	-20%	-25%	-15%	-13%	0%	-1%	2%
Dry (16%)	-65%	36%	35%	8%	23%	-7%	-33%	-20%	-7%	0%	2%	1%
Critical (27%)	-73%	18%	17%	-10%	0%	-26%	-31%	-22%	-1%	8%	6%	1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.3.2 Stanislaus River below Goodwin, Monthly Flow

Revised Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	350	399	400	400	1,825	999	1,500	1,500	1,502	491	319	300
20%	349	356	358	359	863	400	1,500	1,498	1,243	313	300	300
30%	318	334	340	336	400	344	1,429	1,380	948	300	285	281
40%	260	305	323	318	364	312	1,241	1,134	713	296	283	250
50%	193	246	280	250	339	267	879	855	399	283	283	249
60%	146	217	230	183	304	200	649	725	300	271	283	249
70%	123	207	214	152	239	159	517	612	265	265	283	249
80%	115	202	206	136	176	140	462	507	255	265	283	249
90%	104	188	188	122	133	123	403	439	255	265	283	249
Long Term												
Full Simulation Period ^b	250	340	429	530	748	593	958	984	830	433	386	391
Water Year Types^c												
Wet (23%)	334	581	884	1,038	1,692	1,597	1,511	1,556	1,813	860	729	857
Above Normal (24%)	248	269	331	666	712	484	1,051	1,062	986	352	287	268
Below Normal (10%)	254	306	306	336	532	292	1,087	1,021	414	269	283	261
Dry (16%)	245	282	290	253	387	185	686	743	346	276	283	249
Critical (27%)	181	242	252	203	256	174	511	548	278	291	277	233

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	837	290	306	358	897	1,648	1,633	1,929	1,103	429	390	390
20%	797	200	218	232	409	1,521	1,553	1,555	1,090	310	300	300
30%	774	200	200	232	290	440	1,553	1,296	940	300	284	250
40%	774	200	200	226	236	200	1,400	1,242	855	300	283	250
50%	774	200	200	226	236	200	1,400	1,242	363	271	283	250
60%	636	200	200	219	229	200	812	918	363	265	283	249
70%	636	200	200	219	229	200	767	705	297	265	283	249
80%	578	200	200	214	221	200	767	631	261	265	283	249
90%	577	200	200	213	215	200	505	546	255	265	283	249
Long Term												
Full Simulation Period ^b	723	278	365	518	595	754	1,158	1,123	680	394	361	351
Water Year Types^c												
Wet (23%)	781	499	787	999	1,201	2,016	1,536	1,691	1,140	715	639	692
Above Normal (24%)	714	216	282	663	676	645	1,224	1,146	962	353	292	267
Below Normal (10%)	740	225	225	282	346	365	1,454	1,201	476	269	285	256
Dry (16%)	707	208	216	234	313	200	1,030	930	374	275	277	245
Critical (27%)	683	205	215	227	255	234	741	699	281	269	262	231

No Action Alternative minus Revised Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	139%	-27%	-24%	-11%	-51%	65%	9%	29%	-27%	-13%	22%	30%
20%	128%	-44%	-39%	-35%	-53%	280%	4%	4%	-12%	-1%	0%	0%
30%	144%	-40%	-41%	-31%	-28%	28%	9%	-6%	-1%	0%	0%	-11%
40%	197%	-34%	-38%	-29%	-35%	-36%	13%	10%	20%	1%	0%	0%
50%	302%	-19%	-29%	-10%	-30%	-25%	59%	45%	-9%	-4%	0%	1%
60%	337%	-8%	-13%	20%	-25%	0%	25%	27%	21%	-2%	0%	0%
70%	417%	-3%	-6%	44%	-4%	26%	48%	15%	12%	0%	0%	0%
80%	403%	-1%	-3%	57%	26%	43%	66%	24%	2%	0%	0%	0%
90%	458%	6%	6%	75%	62%	63%	25%	24%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	189%	-18%	-15%	-2%	-20%	27%	21%	14%	-18%	-9%	-6%	-10%
Water Year Types^c												
Wet (23%)	134%	-14%	-11%	-4%	-29%	26%	2%	9%	-37%	-17%	-12%	-19%
Above Normal (24%)	188%	-20%	-15%	0%	-5%	33%	17%	8%	-2%	0%	2%	0%
Below Normal (10%)	192%	-26%	-26%	-16%	-35%	25%	34%	18%	15%	0%	1%	-2%
Dry (16%)	189%	-26%	-26%	-8%	-19%	8%	50%	25%	8%	0%	-2%	-1%
Critical (27%)	277%	-15%	-15%	12%	0%	35%	45%	28%	1%	-7%	-5%	-1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.3.3 Stanislaus River below Goodwin, Monthly Flow

Revised Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	350	399	400	400	1,825	999	1,500	1,500	1,502	491	319	300
20%	349	356	358	359	863	400	1,500	1,498	1,243	313	300	300
30%	318	334	340	336	400	344	1,429	1,380	948	300	285	281
40%	260	305	323	318	364	312	1,241	1,134	713	296	283	250
50%	193	246	280	250	339	267	879	855	399	283	283	249
60%	146	217	230	183	304	200	649	725	300	271	283	249
70%	123	207	214	152	239	159	517	612	265	265	283	249
80%	115	202	206	136	176	140	462	507	255	265	283	249
90%	104	188	188	122	133	123	403	439	255	265	283	249
Long Term												
Full Simulation Period ^b	250	340	429	530	748	593	958	984	830	433	386	391
Water Year Types^c												
Wet (23%)	334	581	884	1,038	1,692	1,597	1,511	1,556	1,813	860	729	857
Above Normal (24%)	248	269	331	666	712	484	1,051	1,062	986	352	287	268
Below Normal (10%)	254	306	306	336	532	292	1,087	1,021	414	269	283	261
Dry (16%)	245	282	290	253	387	185	686	743	346	276	283	249
Critical (27%)	181	242	252	203	256	174	511	548	278	291	277	233

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	300	300	609	1,135	2,548	1,189	1,500	1,165	255	265	283	952
20%	300	300	305	300	1,157	344	1,500	1,165	255	265	283	249
30%	300	300	300	300	333	300	1,500	1,165	255	265	283	249
40%	252	300	300	300	300	300	1,034	963	255	265	283	249
50%	252	300	300	150	176	200	893	829	255	265	283	249
60%	252	300	300	150	173	200	893	829	255	265	283	249
70%	252	300	300	150	173	200	893	829	255	265	283	249
80%	200	200	220	150	173	200	528	466	255	265	283	249
90%	200	200	200	150	173	200	493	466	255	265	283	249
Long Term												
Full Simulation Period ^b	302	349	475	557	814	622	1,060	911	490	421	391	397
Water Year Types^c												
Wet (23%)	368	589	1,001	1,066	2,016	1,599	1,538	1,300	1,279	952	768	885
Above Normal (24%)	323	287	394	705	732	552	1,155	955	255	265	283	260
Below Normal (10%)	269	275	275	483	552	272	1,128	909	255	265	283	249
Dry (16%)	285	285	293	251	371	200	815	730	255	265	283	249
Critical (27%)	246	264	274	191	208	218	680	643	245	254	268	240

Alternative 3 minus Revised Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-14%	-25%	52%	184%	40%	19%	0%	-22%	-83%	-46%	-11%	217%
20%	-14%	-16%	-15%	-17%	34%	-14%	0%	-22%	-79%	-15%	-6%	-17%
30%	-6%	-10%	-12%	-11%	-17%	-13%	5%	-16%	-73%	-12%	-1%	-11%
40%	-3%	-2%	-7%	-6%	-18%	-4%	-17%	-15%	-64%	-10%	0%	0%
50%	31%	22%	7%	-40%	-48%	-25%	2%	-3%	-36%	-6%	0%	0%
60%	73%	38%	30%	-18%	-43%	0%	38%	14%	-15%	-2%	0%	0%
70%	105%	45%	40%	-1%	-28%	26%	73%	36%	-3%	0%	0%	0%
80%	74%	-1%	7%	10%	-2%	43%	14%	-8%	0%	0%	0%	0%
90%	93%	6%	6%	23%	30%	63%	22%	6%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	21%	3%	11%	5%	9%	5%	11%	-7%	-41%	-3%	1%	1%
Water Year Types^c												
Wet (23%)	10%	1%	13%	3%	19%	0%	2%	-16%	-29%	11%	5%	3%
Above Normal (24%)	30%	7%	19%	6%	3%	14%	10%	-10%	-74%	-25%	-1%	-3%
Below Normal (10%)	6%	-10%	-10%	44%	4%	-7%	4%	-11%	-38%	-1%	0%	-5%
Dry (16%)	17%	1%	1%	-1%	-4%	8%	19%	-2%	-26%	-4%	0%	0%
Critical (27%)	36%	9%	9%	-6%	-19%	26%	33%	17%	-12%	-13%	-3%	3%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.3.4 Stanislaus River below Goodwin, Monthly Flow

Revised Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	350	399	400	400	1,825	999	1,500	1,500	1,502	491	319	300
20%	349	356	358	359	863	400	1,500	1,498	1,243	313	300	300
30%	318	334	340	336	400	344	1,429	1,380	948	300	285	281
40%	260	305	323	318	364	312	1,241	1,134	713	296	283	250
50%	193	246	280	250	339	267	879	855	399	283	283	249
60%	146	217	230	183	304	200	649	725	300	271	283	249
70%	123	207	214	152	239	159	517	612	265	265	283	249
80%	115	202	206	136	176	140	462	507	255	265	283	249
90%	104	188	188	122	133	123	403	439	255	265	283	249
Long Term												
Full Simulation Period ^b	250	340	429	530	748	593	958	984	830	433	386	391
Water Year Types^c												
Wet (23%)	334	581	884	1,038	1,692	1,597	1,511	1,556	1,813	860	729	857
Above Normal (24%)	248	269	331	666	712	484	1,051	1,062	986	352	287	268
Below Normal (10%)	254	306	306	336	532	292	1,087	1,021	414	269	283	261
Dry (16%)	245	282	290	253	387	185	686	743	346	276	283	249
Critical (27%)	181	242	252	203	256	174	511	548	278	291	277	233

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	797	200	306	358	885	1,636	1,717	1,958	1,103	423	300	300
20%	797	200	211	232	415	1,521	1,633	1,815	979	307	300	300
30%	774	200	200	232	274	343	1,553	1,595	940	300	283	250
40%	774	200	200	226	236	200	1,487	1,555	759	297	283	250
50%	636	200	200	226	236	200	1,400	1,341	363	265	283	249
60%	636	200	200	219	229	200	1,324	1,242	342	265	283	249
70%	636	200	200	219	222	200	1,134	1,068	270	265	283	249
80%	577	200	200	213	221	200	825	887	255	265	283	249
90%	577	200	200	213	214	200	767	798	255	265	283	249
Long Term												
Full Simulation Period ^b	711	276	345	520	580	712	1,317	1,375	660	369	332	341
Water Year Types^c												
Wet (23%)	766	499	690	998	1,169	1,831	1,502	1,730	1,093	619	523	655
Above Normal (24%)	705	211	298	676	659	645	1,170	1,553	962	353	292	267
Below Normal (10%)	733	225	225	281	345	365	1,416	1,267	462	269	285	256
Dry (16%)	690	208	216	233	312	200	1,454	1,370	366	275	277	245
Critical (27%)	674	200	210	221	242	234	1,175	948	257	260	253	224

Alternative 5 minus Revised Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	128%	-50%	-24%	-11%	-52%	64%	14%	31%	-27%	-14%	-6%	0%
20%	128%	-44%	-41%	-35%	-52%	280%	9%	21%	-21%	-2%	0%	0%
30%	144%	-40%	-41%	-31%	-31%	0%	9%	16%	-1%	0%	-1%	-11%
40%	197%	-34%	-38%	-29%	-35%	-36%	20%	37%	6%	0%	0%	0%
50%	230%	-19%	-29%	-10%	-30%	-25%	59%	57%	-9%	-6%	0%	0%
60%	337%	-8%	-13%	20%	-25%	0%	104%	71%	14%	-2%	0%	0%
70%	417%	-3%	-6%	44%	-7%	26%	120%	74%	2%	0%	0%	0%
80%	402%	-1%	-3%	56%	26%	43%	79%	75%	0%	0%	0%	0%
90%	458%	6%	6%	75%	61%	63%	90%	82%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	185%	-19%	-20%	-2%	-22%	20%	37%	40%	-21%	-15%	-14%	-13%
Water Year Types^c												
Wet (23%)	129%	-14%	-22%	-4%	-31%	15%	-1%	11%	-40%	-28%	-28%	-24%
Above Normal (24%)	185%	-22%	-10%	2%	-7%	33%	11%	46%	-2%	0%	2%	0%
Below Normal (10%)	189%	-26%	-26%	-16%	-35%	25%	30%	24%	12%	0%	1%	-2%
Dry (16%)	182%	-26%	-26%	-8%	-19%	8%	112%	84%	6%	0%	-2%	-1%
Critical (27%)	272%	-17%	-16%	9%	-5%	35%	130%	73%	-8%	-11%	-9%	-4%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

5C.3.2.4 Stanislaus River at Mouth Flow

Table 5C.3.2.4.1 Stanislaus River at Mouth, Monthly Flow

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,122	463	442	576	1,084	1,969	1,886	1,989	1,536	751	587	646
20%	1,029	384	368	427	643	1,708	1,769	1,647	1,334	606	488	507
30%	982	348	319	368	472	520	1,696	1,536	1,221	502	462	473
40%	958	337	304	347	406	433	1,610	1,362	1,053	442	445	443
50%	879	319	290	337	369	367	1,485	1,289	635	412	445	439
60%	826	292	281	326	331	336	936	873	510	383	416	428
70%	772	267	262	312	279	314	806	755	406	372	395	389
80%	755	260	241	295	253	241	686	646	358	341	371	360
90%	676	248	224	273	230	207	572	576	311	308	331	318
Long Term												
Full Simulation Period ^b	903	398	448	630	719	903	1,279	1,207	883	546	505	533
Water Year Types^c												
Wet (23%)	952	624	881	1,115	1,412	2,258	1,779	1,828	1,456	976	831	946
Above Normal (24%)	907	347	357	776	786	801	1,410	1,244	1,257	534	467	480
Below Normal (10%)	932	354	358	430	517	539	1,556	1,378	669	449	440	429
Dry (16%)	916	322	300	349	405	345	1,064	1,002	530	375	397	399
Critical (27%)	837	310	277	317	319	286	754	695	335	321	346	342

Revised Alternative 1

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	653	567	590	624	2,437	1,243	1,824	1,680	1,791	932	588	706
20%	577	482	480	506	987	615	1,626	1,588	1,545	564	488	506
30%	491	441	431	462	560	531	1,495	1,515	1,261	499	458	473
40%	424	409	382	434	498	458	1,303	1,285	1,041	443	445	446
50%	377	386	336	392	442	405	1,022	903	726	412	441	439
60%	314	344	312	279	399	311	716	756	418	389	420	431
70%	284	313	291	248	320	277	584	601	375	374	396	397
80%	248	270	270	229	232	226	469	541	347	349	374	370
90%	185	243	204	199	178	146	424	471	312	317	347	320
Long Term												
Full Simulation Period ^b	430	460	512	642	872	741	1,079	1,067	1,034	585	530	573
Water Year Types^c												
Wet (23%)	505	706	978	1,155	1,903	1,839	1,754	1,693	2,130	1,121	921	1,111
Above Normal (24%)	441	400	406	779	822	641	1,237	1,160	1,281	533	461	480
Below Normal (10%)	445	435	438	484	703	466	1,189	1,197	607	449	438	434
Dry (16%)	454	397	375	368	479	330	720	816	502	376	404	402
Critical (27%)	336	347	314	294	320	226	524	544	332	343	361	344

Revised Alternative 1 minus No Action Alternative

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-42%	22%	33%	8%	125%	-37%	-3%	-16%	17%	24%	0%	9%
20%	-44%	26%	31%	19%	54%	-64%	-8%	-4%	16%	-7%	0%	0%
30%	-50%	27%	35%	26%	19%	2%	-12%	-1%	3%	-1%	-1%	0%
40%	-56%	21%	25%	25%	23%	6%	-19%	-6%	-1%	0%	0%	1%
50%	-57%	21%	16%	16%	20%	10%	-31%	-30%	14%	0%	-1%	0%
60%	-62%	18%	11%	-14%	21%	-7%	-23%	-13%	-18%	1%	1%	1%
70%	-63%	18%	11%	-20%	14%	-12%	-28%	-20%	-8%	0%	0%	2%
80%	-67%	4%	12%	-22%	-8%	-6%	-32%	-16%	-3%	3%	1%	3%
90%	-73%	-2%	-9%	-27%	-22%	-29%	-26%	-18%	0%	3%	5%	1%
Long Term												
Full Simulation Period ^b	-52%	16%	14%	2%	21%	-18%	-16%	-12%	17%	7%	5%	7%
Water Year Types^c												
Wet (23%)	-47%	13%	11%	4%	35%	-19%	-1%	-7%	46%	15%	11%	17%
Above Normal (24%)	-51%	15%	14%	0%	5%	-20%	-12%	-7%	2%	0%	-1%	0%
Below Normal (10%)	-52%	23%	23%	13%	36%	-14%	-24%	-13%	-9%	0%	0%	1%
Dry (16%)	-50%	23%	25%	5%	18%	-4%	-32%	-19%	-5%	0%	2%	1%
Critical (27%)	-60%	12%	13%	-7%	0%	-21%	-30%	-22%	-1%	7%	4%	1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.4.2 Stanislaus River at Mouth, Monthly Flow

Revised Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	653	567	590	624	2,437	1,243	1,824	1,680	1,791	932	588	706
20%	577	482	480	506	987	615	1,626	1,588	1,545	564	488	506
30%	491	441	431	462	560	531	1,495	1,515	1,261	499	458	473
40%	424	409	382	434	498	458	1,303	1,285	1,041	443	445	446
50%	377	386	336	392	442	405	1,022	903	726	412	441	439
60%	314	344	312	279	399	311	716	756	418	389	420	431
70%	284	313	291	248	320	277	584	601	375	374	396	397
80%	248	270	270	229	232	226	469	541	347	349	374	370
90%	185	243	204	199	178	146	424	471	312	317	347	320
Long Term												
Full Simulation Period ^b	430	460	512	642	872	741	1,079	1,067	1,034	585	530	573
Water Year Types^c												
Wet (23%)	505	706	978	1,155	1,903	1,839	1,754	1,693	2,130	1,121	921	1,111
Above Normal (24%)	441	400	406	779	822	641	1,237	1,160	1,281	533	461	480
Below Normal (10%)	445	435	438	484	703	466	1,189	1,197	607	449	438	434
Dry (16%)	454	397	375	368	479	330	720	816	502	376	404	402
Critical (27%)	336	347	314	294	320	226	524	544	332	343	361	344

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,122	463	442	576	1,084	1,969	1,886	1,989	1,536	751	587	646
20%	1,029	384	368	427	643	1,708	1,769	1,647	1,334	606	488	507
30%	982	348	319	368	472	520	1,696	1,536	1,221	502	462	473
40%	958	337	304	347	406	433	1,610	1,362	1,053	442	445	443
50%	879	319	290	337	369	367	1,485	1,289	635	412	445	439
60%	826	292	281	326	331	336	936	873	510	383	416	428
70%	772	267	262	312	279	314	806	755	406	372	395	389
80%	755	260	241	295	253	241	686	646	358	341	371	360
90%	676	248	224	273	230	207	572	576	311	308	331	318
Long Term												
Full Simulation Period ^b	903	398	448	630	719	903	1,279	1,207	883	546	505	533
Water Year Types^c												
Wet (23%)	952	624	881	1,115	1,412	2,258	1,779	1,828	1,456	976	831	946
Above Normal (24%)	907	347	357	776	786	801	1,410	1,244	1,257	534	467	480
Below Normal (10%)	932	354	358	430	517	539	1,556	1,378	669	449	440	429
Dry (16%)	916	322	300	349	405	345	1,064	1,002	530	375	397	399
Critical (27%)	837	310	277	317	319	286	754	695	335	321	346	342

No Action Alternative minus Revised Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	72%	-18%	-25%	-8%	-56%	58%	3%	18%	-14%	-19%	0%	-9%
20%	78%	-20%	-23%	-16%	-35%	178%	9%	4%	-14%	7%	0%	0%
30%	100%	-21%	-26%	-20%	-16%	-2%	13%	1%	-3%	1%	1%	0%
40%	126%	-18%	-20%	-20%	-19%	-5%	24%	6%	1%	0%	0%	-1%
50%	133%	-17%	-14%	-14%	-16%	-9%	45%	43%	-13%	0%	1%	0%
60%	163%	-15%	-10%	17%	-17%	8%	31%	15%	22%	-1%	-1%	-1%
70%	171%	-15%	-10%	26%	-13%	13%	38%	26%	8%	0%	0%	-2%
80%	204%	-4%	-11%	29%	9%	7%	46%	19%	3%	-2%	-1%	-3%
90%	265%	2%	10%	37%	29%	42%	35%	22%	0%	-3%	-5%	-1%
Long Term												
Full Simulation Period ^b	110%	-13%	-13%	-2%	-18%	22%	19%	13%	-15%	-7%	-5%	-7%
Water Year Types^c												
Wet (23%)	88%	-12%	-10%	-3%	-26%	23%	1%	8%	-32%	-13%	-10%	-15%
Above Normal (24%)	106%	-13%	-12%	0%	-4%	25%	14%	7%	-2%	0%	1%	0%
Below Normal (10%)	109%	-19%	-18%	-11%	-26%	16%	31%	15%	10%	0%	0%	-1%
Dry (16%)	102%	-19%	-20%	-5%	-15%	4%	48%	23%	6%	0%	-2%	-1%
Critical (27%)	149%	-11%	-12%	8%	0%	27%	44%	28%	1%	-6%	-4%	-1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.4.3 Stanislaus River at Mouth, Monthly Flow

Revised Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	653	567	590	624	2,437	1,243	1,824	1,680	1,791	932	588	706
20%	577	482	480	506	987	615	1,626	1,588	1,545	564	488	506
30%	491	441	431	462	560	531	1,495	1,515	1,261	499	458	473
40%	424	409	382	434	498	458	1,303	1,285	1,041	443	445	446
50%	377	386	336	392	442	405	1,022	903	726	412	441	439
60%	314	344	312	279	399	311	716	756	418	389	420	431
70%	284	313	291	248	320	277	584	601	375	374	396	397
80%	248	270	270	229	232	226	469	541	347	349	374	370
90%	185	243	204	199	178	146	424	471	312	317	347	320
Long Term												
Full Simulation Period ^b	430	460	512	642	872	741	1,079	1,067	1,034	585	530	573
Water Year Types^c												
Wet (23%)	505	706	978	1,155	1,903	1,839	1,754	1,693	2,130	1,121	921	1,111
Above Normal (24%)	441	400	406	779	822	641	1,237	1,160	1,281	533	461	480
Below Normal (10%)	445	435	438	484	703	466	1,189	1,197	607	449	438	434
Dry (16%)	454	397	375	368	479	330	720	816	502	376	404	402
Critical (27%)	336	347	314	294	320	226	524	544	332	343	361	344

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	679	485	722	1,267	2,628	1,444	1,865	1,414	950	885	571	1,146
20%	557	456	438	518	1,301	734	1,634	1,306	679	535	480	489
30%	482	441	411	410	502	486	1,552	1,233	558	476	457	450
40%	448	424	400	374	416	419	1,240	1,043	428	424	445	439
50%	435	402	381	311	366	367	1,064	920	413	382	440	435
60%	392	372	362	275	308	334	996	882	374	374	410	415
70%	377	359	325	251	238	312	893	829	352	350	390	384
80%	360	333	300	232	201	238	575	550	304	327	367	360
90%	293	260	239	198	180	203	493	489	273	290	347	320
Long Term												
Full Simulation Period ^b	482	469	558	669	938	770	1,180	995	693	573	535	578
Water Year Types^c												
Wet (23%)	539	714	1,096	1,183	2,227	1,841	1,781	1,437	1,596	1,213	961	1,139
Above Normal (24%)	516	418	468	818	843	708	1,341	1,054	550	446	457	473
Below Normal (10%)	461	404	408	632	723	446	1,230	1,086	449	445	438	422
Dry (16%)	495	399	377	365	463	345	849	803	411	365	404	402
Critical (27%)	401	369	336	282	272	271	692	639	299	305	351	351

Alternative 3 minus Revised Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4%	-14%	22%	103%	8%	16%	2%	-16%	-47%	-5%	-3%	62%
20%	-3%	-5%	-9%	2%	32%	19%	1%	-18%	-56%	-5%	-2%	-3%
30%	-2%	0%	-5%	-11%	-10%	-8%	4%	-19%	-56%	-4%	0%	-5%
40%	6%	4%	5%	-14%	-16%	-8%	-5%	-19%	-59%	-4%	0%	-1%
50%	15%	4%	13%	-21%	-17%	-9%	4%	2%	-43%	-7%	0%	-1%
60%	25%	8%	16%	-2%	-23%	7%	39%	17%	-11%	-4%	-2%	-4%
70%	33%	15%	12%	1%	-25%	12%	53%	38%	-6%	-6%	-2%	-3%
80%	45%	23%	11%	1%	-13%	6%	23%	2%	-13%	-6%	-2%	-3%
90%	58%	7%	17%	0%	1%	39%	16%	4%	-13%	-9%	0%	0%
Long Term												
Full Simulation Period ^b	12%	2%	9%	4%	8%	4%	9%	-7%	-33%	-2%	1%	1%
Water Year Types^c												
Wet (23%)	7%	1%	12%	2%	17%	0%	2%	-15%	-25%	8%	4%	2%
Above Normal (24%)	17%	5%	15%	5%	3%	11%	8%	-9%	-57%	-16%	-1%	-2%
Below Normal (10%)	3%	-7%	-7%	30%	3%	-4%	3%	-9%	-26%	-1%	0%	-3%
Dry (16%)	9%	1%	1%	-1%	-3%	4%	18%	-2%	-18%	-3%	0%	0%
Critical (27%)	19%	6%	7%	-4%	-15%	20%	32%	17%	-10%	-11%	-3%	2%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.4.4 Stanislaus River at Mouth, Monthly Flow

Revised Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	653	567	590	624	2,437	1,243	1,824	1,680	1,791	932	588	706
20%	577	482	480	506	987	615	1,626	1,588	1,545	564	488	506
30%	491	441	431	462	560	531	1,495	1,515	1,261	499	458	473
40%	424	409	382	434	498	458	1,303	1,285	1,041	443	445	446
50%	377	386	336	392	442	405	1,022	903	726	412	441	439
60%	314	344	312	279	399	311	716	756	418	389	420	431
70%	284	313	291	248	320	277	584	601	375	374	396	397
80%	248	270	270	229	232	226	469	541	347	349	374	370
90%	185	243	204	199	178	146	424	471	312	317	347	320
Long Term												
Full Simulation Period ^b	430	460	512	642	872	741	1,079	1,067	1,034	585	530	573
Water Year Types^c												
Wet (23%)	505	706	978	1,155	1,903	1,839	1,754	1,693	2,130	1,121	921	1,111
Above Normal (24%)	441	400	406	779	822	641	1,237	1,160	1,281	533	461	480
Below Normal (10%)	445	435	438	484	703	466	1,189	1,197	607	449	438	434
Dry (16%)	454	397	375	368	479	330	720	816	502	376	404	402
Critical (27%)	336	347	314	294	320	226	524	544	332	343	361	344

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,121	456	442	570	1,081	1,952	1,950	2,148	1,536	719	571	659
20%	1,029	382	378	416	586	1,708	1,815	1,974	1,319	564	488	501
30%	979	348	319	363	483	495	1,707	1,806	1,139	502	461	473
40%	903	336	304	347	401	415	1,630	1,672	1,034	442	445	443
50%	854	318	290	337	368	365	1,529	1,434	635	407	443	439
60%	818	292	281	326	319	333	1,311	1,290	485	382	413	428
70%	764	267	262	312	272	312	1,168	1,183	383	371	389	389
80%	748	260	241	295	245	241	1,044	962	343	339	367	356
90%	681	248	224	270	230	207	865	752	300	307	305	316
Long Term												
Full Simulation Period ^b	891	396	428	631	704	860	1,437	1,458	863	521	476	522
Water Year Types^c												
Wet (23%)	937	624	784	1,115	1,380	2,073	1,744	1,866	1,409	880	716	909
Above Normal (24%)	898	342	372	790	770	801	1,356	1,651	1,257	534	467	480
Below Normal (10%)	925	354	358	430	516	539	1,518	1,444	656	449	440	429
Dry (16%)	900	322	300	347	403	345	1,488	1,442	522	375	397	399
Critical (27%)	829	306	272	311	306	286	1,187	944	310	311	337	335

Alternative 5 minus Revised Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	72%	-20%	-25%	-9%	-56%	57%	7%	28%	-14%	-23%	-3%	-7%
20%	78%	-21%	-21%	-18%	-41%	178%	12%	24%	-15%	0%	0%	-1%
30%	99%	-21%	-26%	-22%	-14%	-7%	14%	19%	-10%	1%	1%	0%
40%	113%	-18%	-20%	-20%	-19%	-9%	25%	30%	-1%	0%	0%	-1%
50%	127%	-18%	-14%	-14%	-17%	-10%	50%	59%	-13%	-1%	0%	0%
60%	160%	-15%	-10%	17%	-20%	7%	83%	71%	16%	-2%	-2%	-1%
70%	169%	-15%	-10%	26%	-15%	12%	100%	97%	2%	-1%	-2%	-2%
80%	201%	-4%	-11%	29%	6%	7%	122%	78%	-1%	-3%	-2%	-4%
90%	268%	2%	10%	36%	29%	42%	104%	60%	-4%	-3%	-12%	-1%
Long Term												
Full Simulation Period ^b	107%	-14%	-16%	-2%	-19%	16%	33%	37%	-17%	-11%	-10%	-9%
Water Year Types^c												
Wet (23%)	85%	-12%	-20%	-3%	-28%	13%	-1%	10%	-34%	-21%	-22%	-18%
Above Normal (24%)	104%	-15%	-8%	1%	-6%	25%	10%	42%	-2%	0%	1%	0%
Below Normal (10%)	108%	-19%	-18%	-11%	-27%	16%	28%	21%	8%	0%	0%	-1%
Dry (16%)	98%	-19%	-20%	-6%	-16%	4%	107%	77%	4%	0%	-2%	-1%
Critical (27%)	147%	-12%	-13%	6%	-4%	27%	127%	74%	-6%	-9%	-7%	-3%

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

5C.3.2.5 Stanislaus River below New Melones Temperature

Table 5C.3.2.5.1 Stanislaus River below New Melones Reservoir, Monthly Temperature

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	58.8	56.0	53.6	52.1	51.1	50.7	51.0	51.6	52.6	53.7	55.1	57.5
20%	55.6	54.6	52.7	51.5	50.4	49.9	50.2	51.1	51.8	52.5	53.0	54.4
30%	53.4	53.3	52.3	50.9	49.7	49.5	49.9	50.5	51.1	51.8	52.5	53.0
40%	52.9	52.8	51.8	50.6	49.4	49.2	49.7	50.3	50.8	51.4	51.9	52.5
50%	52.4	52.5	51.6	50.2	49.2	49.0	49.3	49.7	50.3	51.1	51.6	52.0
60%	52.0	52.1	51.4	49.9	48.9	48.7	48.9	49.3	49.7	50.4	50.9	51.4
70%	51.4	51.6	51.0	49.6	48.7	48.1	48.4	49.0	49.3	50.0	50.5	51.0
80%	51.1	51.2	50.3	49.2	48.0	47.5	48.0	48.4	48.9	49.6	50.1	50.7
90%	49.9	49.9	49.8	48.3	47.0	46.8	46.9	47.2	47.5	48.5	48.9	49.3
Long Term												
Full Simulation Period ^b	53.4	52.8	51.7	50.2	49.1	48.8	49.2	49.9	50.6	51.3	52.2	53.1
Water Year Types^c												
Wet (23%)	49.6	49.6	48.7	49.4	48.1	47.9	47.8	48.1	48.5	49.0	49.5	49.9
Above Normal (24%)	53.8	52.7	51.2	49.5	48.2	48.0	48.4	48.9	49.6	50.4	51.4	52.2
Below Normal (10%)	52.6	52.2	51.3	50.2	49.2	48.8	49.1	49.6	50.2	50.9	51.5	52.1
Dry (16%)	52.3	52.4	51.8	50.7	49.8	49.4	49.7	50.3	51.0	51.9	52.9	53.8
Critical (27%)	54.8	53.7	52.5	51.2	50.4	50.0	50.8	52.1	53.1	53.9	54.9	56.8

Revised Alternative 1

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	54.7	54.8	53.5	52.1	51.2	50.7	51.0	51.5	52.1	53.0	53.7	54.1
20%	53.8	53.9	52.7	51.5	50.4	50.1	50.2	50.9	51.5	52.0	52.7	53.1
30%	52.8	52.8	52.3	50.9	50.0	49.6	49.9	50.4	50.9	51.4	52.2	52.5
40%	52.3	52.3	51.7	50.7	49.6	49.3	49.7	50.2	50.6	51.1	51.7	52.0
50%	51.8	51.9	51.4	50.3	49.4	49.1	49.3	49.6	50.1	50.7	51.3	51.6
60%	51.3	51.6	51.3	50.1	49.1	48.7	48.9	49.3	49.8	50.3	50.7	51.1
70%	51.1	51.4	51.0	49.8	48.9	48.4	48.7	49.0	49.4	50.0	50.5	50.8
80%	50.6	50.9	50.6	49.4	48.5	48.0	47.9	48.4	49.1	49.5	50.0	50.4
90%	49.8	50.0	50.1	49.1	47.6	47.1	47.2	47.5	48.0	48.6	49.1	49.4
Long Term												
Full Simulation Period ^b	52.5	52.4	51.6	50.4	49.4	49.0	49.2	49.7	50.2	50.9	51.8	52.2
Water Year Types^c												
Wet (23%)	48.9	49.0	48.5	49.5	48.2	47.9	48.0	48.3	48.7	49.1	49.6	50.0
Above Normal (24%)	53.1	52.8	51.6	49.9	48.7	48.2	48.4	48.8	49.4	50.0	50.8	51.4
Below Normal (10%)	51.5	51.6	51.1	50.4	49.4	49.0	49.2	49.6	50.1	50.6	51.1	51.6
Dry (16%)	51.5	51.7	51.4	50.6	49.9	49.6	49.8	50.2	50.8	51.3	51.9	52.5
Critical (27%)	53.6	53.4	52.4	51.4	50.7	50.2	50.6	51.4	52.2	53.2	54.8	55.0

Revised Alternative 1 minus No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-4.1	-1.3	-0.2	0.0	0.1	0.0	0.0	-0.1	-0.5	-0.7	-1.4	-3.4
20%	-1.9	-0.7	-0.1	0.0	0.0	0.2	0.0	-0.2	-0.3	-0.5	-0.3	-1.3
30%	-0.6	-0.4	0.0	0.0	0.2	0.1	0.0	-0.1	-0.2	-0.4	-0.3	-0.5
40%	-0.7	-0.5	-0.2	0.1	0.2	0.1	0.0	-0.1	-0.2	-0.3	-0.2	-0.5
50%	-0.6	-0.6	-0.1	0.1	0.2	0.1	0.0	-0.1	-0.2	-0.4	-0.3	-0.4
60%	-0.7	-0.5	0.0	0.2	0.1	0.0	0.0	0.0	0.0	-0.1	-0.2	-0.3
70%	-0.2	-0.2	0.0	0.2	0.2	0.3	0.3	0.1	0.1	-0.1	0.0	-0.2
80%	-0.5	-0.3	0.2	0.2	0.5	0.5	-0.1	0.0	0.2	-0.1	-0.1	-0.4
90%	-0.1	0.1	0.3	0.8	0.6	0.2	0.2	0.3	0.4	0.1	0.2	0.1
Long Term												
Full Simulation Period ^b	-0.9	-0.4	0.0	0.2	0.3	0.2	0.0	-0.2	-0.3	-0.4	-0.4	-0.9
Water Year Types^c												
Wet (23%)	-0.7	-0.6	-0.2	0.1	0.2	0.1	0.2	0.2	0.2	0.1	0.1	0.0
Above Normal (24%)	-0.7	0.1	0.4	0.4	0.5	0.2	0.0	-0.1	-0.2	-0.4	-0.6	-0.8
Below Normal (10%)	-1.1	-0.6	-0.2	0.1	0.2	0.2	0.0	-0.1	-0.3	-0.4	-0.5	-0.5
Dry (16%)	-0.8	-0.7	-0.4	-0.1	0.1	0.2	0.1	-0.1	-0.2	-0.6	-1.0	-1.3
Critical (27%)	-1.2	-0.2	0.0	0.2	0.3	0.3	-0.2	-0.7	-1.0	-0.7	-0.2	-1.8

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.5.2 Stanislaus River below New Melones Reservoir, Monthly Temperature

Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	54.7	54.8	53.5	52.1	51.2	50.7	51.0	51.5	52.1	53.0	53.7	54.1
20%	53.8	53.9	52.7	51.5	50.4	50.1	50.2	50.9	51.5	52.0	52.7	53.1
30%	52.8	52.8	52.3	50.9	50.0	49.6	49.9	50.4	50.9	51.4	52.2	52.5
40%	52.3	52.3	51.7	50.7	49.6	49.3	49.7	50.2	50.6	51.1	51.7	52.0
50%	51.8	51.9	51.4	50.3	49.4	49.1	49.3	49.6	50.1	50.7	51.3	51.6
60%	51.3	51.6	51.3	50.1	49.1	48.7	48.9	49.3	49.8	50.3	50.7	51.1
70%	51.1	51.4	51.0	49.8	48.9	48.4	48.7	49.0	49.4	50.0	50.5	50.8
80%	50.6	50.9	50.6	49.4	48.5	48.0	47.9	48.4	49.1	49.5	50.0	50.4
90%	49.8	50.0	50.1	49.1	47.6	47.1	47.2	47.5	48.0	48.6	49.1	49.4
Long Term												
Full Simulation Period ^b	52.5	52.4	51.6	50.4	49.4	49.0	49.2	49.7	50.2	50.9	51.8	52.2
Water Year Types^c												
Wet (23%)	48.9	49.0	48.5	49.5	48.2	47.9	48.0	48.3	48.7	49.1	49.6	50.0
Above Normal (24%)	53.1	52.8	51.6	49.9	48.7	48.2	48.4	48.8	49.4	50.0	50.8	51.4
Below Normal (10%)	51.5	51.6	51.1	50.4	49.4	49.0	49.2	49.6	50.1	50.6	51.1	51.6
Dry (16%)	51.5	51.7	51.4	50.6	49.9	49.6	49.8	50.2	50.8	51.3	51.9	52.5
Critical (27%)	53.6	53.4	52.4	51.4	50.7	50.2	50.6	51.4	52.2	53.2	54.8	55.0

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	58.8	56.0	53.6	52.1	51.1	50.7	51.0	51.6	52.6	53.7	55.1	57.5
20%	55.6	54.6	52.7	51.5	50.4	49.9	50.2	51.1	51.8	52.5	53.0	54.4
30%	53.4	53.3	52.3	50.9	49.7	49.5	49.9	50.5	51.1	51.8	52.5	53.0
40%	52.9	52.8	51.8	50.6	49.4	49.2	49.7	50.3	50.8	51.4	51.9	52.5
50%	52.4	52.5	51.6	50.2	49.2	49.0	49.3	49.7	50.3	51.1	51.6	52.0
60%	52.0	52.1	51.4	49.9	48.9	48.7	48.9	49.3	49.7	50.4	50.9	51.4
70%	51.4	51.6	51.0	49.6	48.7	48.1	48.4	49.0	49.3	50.0	50.5	51.0
80%	51.1	51.2	50.3	49.2	48.0	47.5	48.0	48.4	48.9	49.6	50.1	50.7
90%	49.9	49.9	49.8	48.3	47.0	46.8	46.9	47.2	47.5	48.5	48.9	49.3
Long Term												
Full Simulation Period ^b	53.4	52.8	51.7	50.2	49.1	48.8	49.2	49.9	50.6	51.3	52.2	53.1
Water Year Types^c												
Wet (23%)	49.6	49.6	48.7	49.4	48.1	47.9	47.8	48.1	48.5	49.0	49.5	49.9
Above Normal (24%)	53.8	52.7	51.2	49.5	48.2	48.0	48.4	48.9	49.6	50.4	51.4	52.2
Below Normal (10%)	52.6	52.2	51.3	50.2	49.2	48.8	49.1	49.6	50.2	50.9	51.5	52.1
Dry (16%)	52.3	52.4	51.8	50.7	49.8	49.4	49.7	50.3	51.0	51.9	52.9	53.8
Critical (27%)	54.8	53.7	52.5	51.2	50.4	50.0	50.8	52.1	53.1	53.9	54.9	56.8

No Action Alternative minus Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4.1	1.3	0.2	0.0	-0.1	0.0	0.0	0.1	0.5	0.7	1.4	3.4
20%	1.9	0.7	0.1	0.0	0.0	-0.2	0.0	0.2	0.3	0.5	0.3	1.3
30%	0.6	0.4	0.0	0.0	-0.2	-0.1	0.0	0.1	0.2	0.4	0.3	0.5
40%	0.7	0.5	0.2	-0.1	-0.2	-0.1	0.0	0.1	0.2	0.3	0.2	0.5
50%	0.6	0.6	0.1	-0.1	-0.2	-0.1	0.0	0.1	0.2	0.4	0.3	0.4
60%	0.7	0.5	0.0	-0.2	-0.1	0.0	0.0	0.0	0.0	0.1	0.2	0.3
70%	0.2	0.2	0.0	-0.2	-0.2	-0.3	-0.3	-0.1	-0.1	0.1	0.0	0.2
80%	0.5	0.3	-0.2	-0.2	-0.5	-0.5	0.1	0.0	-0.2	0.1	0.1	0.4
90%	0.1	-0.1	-0.3	-0.8	-0.6	-0.2	-0.2	-0.3	-0.4	-0.1	-0.2	-0.1
Long Term												
Full Simulation Period ^b	0.9	0.4	0.0	-0.2	-0.3	-0.2	0.0	0.2	0.3	0.4	0.4	0.9
Water Year Types^c												
Wet (23%)	0.7	0.6	0.2	-0.1	-0.2	-0.1	-0.2	-0.2	-0.2	-0.1	-0.1	0.0
Above Normal (24%)	0.7	-0.1	-0.4	-0.4	-0.5	-0.2	0.0	0.1	0.2	0.4	0.6	0.8
Below Normal (10%)	1.1	0.6	0.2	-0.1	-0.2	-0.2	0.0	0.1	0.3	0.4	0.5	0.5
Dry (16%)	0.8	0.7	0.4	0.1	-0.1	-0.2	-0.1	0.1	0.2	0.6	1.0	1.3
Critical (27%)	1.2	0.2	0.0	-0.2	-0.3	-0.3	0.2	0.7	1.0	0.7	0.2	1.8

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.5.3 Stanislaus River below New Melones Reservoir, Monthly Temperature

Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	54.7	54.8	53.5	52.1	51.2	50.7	51.0	51.5	52.1	53.0	53.7	54.1
20%	53.8	53.9	52.7	51.5	50.4	50.1	50.2	50.9	51.5	52.0	52.7	53.1
30%	52.8	52.8	52.3	50.9	50.0	49.6	49.9	50.4	50.9	51.4	52.2	52.5
40%	52.3	52.3	51.7	50.7	49.6	49.3	49.7	50.2	50.6	51.1	51.7	52.0
50%	51.8	51.9	51.4	50.3	49.4	49.1	49.3	49.6	50.1	50.7	51.3	51.6
60%	51.3	51.6	51.3	50.1	49.1	48.7	48.9	49.3	49.8	50.3	50.7	51.1
70%	51.1	51.4	51.0	49.8	48.9	48.4	48.7	49.0	49.4	50.0	50.5	50.8
80%	50.6	50.9	50.6	49.4	48.5	48.0	47.9	48.4	49.1	49.5	50.0	50.4
90%	49.8	50.0	50.1	49.1	47.6	47.1	47.2	47.5	48.0	48.6	49.1	49.4
Long Term												
Full Simulation Period ^b	52.5	52.4	51.6	50.4	49.4	49.0	49.2	49.7	50.2	50.9	51.8	52.2
Water Year Types^c												
Wet (23%)	48.9	49.0	48.5	49.5	48.2	47.9	48.0	48.3	48.7	49.1	49.6	50.0
Above Normal (24%)	53.1	52.8	51.6	49.9	48.7	48.2	48.4	48.8	49.4	50.0	50.8	51.4
Below Normal (10%)	51.5	51.6	51.1	50.4	49.4	49.0	49.2	49.6	50.1	50.6	51.1	51.6
Dry (16%)	51.5	51.7	51.4	50.6	49.9	49.6	49.8	50.2	50.8	51.3	51.9	52.5
Critical (27%)	53.6	53.4	52.4	51.4	50.7	50.2	50.6	51.4	52.2	53.2	54.8	55.0

Alternative 3

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	55.7	55.3	53.2	52.3	51.1	50.8	51.1	51.6	52.2	53.0	53.7	54.9
20%	53.6	53.7	52.5	51.4	50.4	50.1	50.3	50.9	51.6	52.1	52.6	53.3
30%	52.6	52.7	52.1	51.0	49.9	49.6	50.0	50.4	50.9	51.5	52.0	52.5
40%	52.1	52.3	51.7	50.6	49.5	49.3	49.7	50.2	50.5	51.2	51.6	52.0
50%	51.7	51.9	51.4	50.3	49.5	49.2	49.3	49.6	50.0	50.6	51.1	51.5
60%	51.3	51.6	51.3	50.0	49.1	48.7	49.0	49.3	49.7	50.2	50.7	51.2
70%	51.1	51.3	51.0	49.7	48.8	48.5	48.7	49.1	49.5	49.9	50.4	50.8
80%	50.6	50.8	50.5	49.3	48.4	48.1	48.2	48.5	48.9	49.3	49.7	50.4
90%	49.7	49.9	50.0	48.4	47.3	47.1	47.3	47.6	48.0	48.5	48.9	49.4
Long Term												
Full Simulation Period ^b	52.5	52.4	51.6	50.3	49.3	49.0	49.3	49.7	50.3	51.1	51.6	52.1
Water Year Types^c												
Wet (23%)	48.8	49.0	48.5	49.4	48.3	47.9	48.0	48.3	48.6	49.0	49.5	49.9
Above Normal (24%)	53.4	52.8	51.4	49.7	48.4	48.2	48.5	48.8	49.3	50.0	50.7	51.3
Below Normal (10%)	51.5	51.5	51.0	50.4	49.4	49.0	49.2	49.6	50.1	50.6	51.1	51.5
Dry (16%)	51.4	51.6	51.3	50.5	49.8	49.5	49.8	50.2	50.7	51.3	51.9	52.5
Critical (27%)	53.3	53.3	52.4	51.4	50.7	50.3	50.8	51.5	52.6	53.9	54.4	54.7

Alternative 3 minus Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.9	0.5	-0.2	0.2	-0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.8
20%	-0.1	-0.2	-0.1	-0.1	0.0	0.0	0.1	0.1	0.1	0.1	0.0	0.2
30%	-0.1	-0.1	-0.2	0.0	-0.1	0.0	0.1	0.0	0.0	0.0	-0.2	0.0
40%	-0.2	-0.1	0.0	-0.1	-0.1	0.0	0.0	0.0	-0.1	0.1	-0.1	-0.1
50%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.2	-0.2	-0.1
60%	0.0	-0.1	-0.1	-0.1	0.0	0.0	0.1	0.0	0.0	-0.1	0.0	0.0
70%	-0.1	-0.1	0.0	-0.1	-0.1	0.1	0.1	0.0	0.0	-0.1	-0.1	0.0
80%	0.0	-0.2	0.0	-0.1	-0.1	0.0	0.3	0.1	-0.1	-0.2	-0.3	0.0
90%	-0.2	-0.1	-0.1	-0.7	-0.2	0.1	0.1	0.1	0.1	0.0	-0.2	0.0
Long Term												
Full Simulation Period ^b	0.0	-0.1	-0.1	-0.1	-0.1	0.0	0.1	0.0	0.1	0.2	-0.1	-0.1
Water Year Types^c												
Wet (23%)	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1
Above Normal (24%)	0.3	0.0	-0.2	-0.2	-0.3	-0.1	0.1	0.0	0.0	-0.1	-0.1	0.0
Below Normal (10%)	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Dry (16%)	-0.1	-0.1	-0.1	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (27%)	-0.3	-0.1	0.0	0.0	0.0	0.1	0.2	0.1	0.4	0.7	-0.4	-0.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.5.4 Stanislaus River below New Melones Reservoir, Monthly Temperature

Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	54.7	54.8	53.5	52.1	51.2	50.7	51.0	51.5	52.1	53.0	53.7	54.1
20%	53.8	53.9	52.7	51.5	50.4	50.1	50.2	50.9	51.5	52.0	52.7	53.1
30%	52.8	52.8	52.3	50.9	50.0	49.6	49.9	50.4	50.9	51.4	52.2	52.5
40%	52.3	52.3	51.7	50.7	49.6	49.3	49.7	50.2	50.6	51.1	51.7	52.0
50%	51.8	51.9	51.4	50.3	49.4	49.1	49.3	49.6	50.1	50.7	51.3	51.6
60%	51.3	51.6	51.3	50.1	49.1	48.7	48.9	49.3	49.8	50.3	50.7	51.1
70%	51.1	51.4	51.0	49.8	48.9	48.4	48.7	49.0	49.4	50.0	50.5	50.8
80%	50.6	50.9	50.6	49.4	48.5	48.0	47.9	48.4	49.1	49.5	50.0	50.4
90%	49.8	50.0	50.1	49.1	47.6	47.1	47.2	47.5	48.0	48.6	49.1	49.4
Long Term												
Full Simulation Period ^b	52.5	52.4	51.6	50.4	49.4	49.0	49.2	49.7	50.2	50.9	51.8	52.2
Water Year Types^c												
Wet (23%)	48.9	49.0	48.5	49.5	48.2	47.9	48.0	48.3	48.7	49.1	49.6	50.0
Above Normal (24%)	53.1	52.8	51.6	49.9	48.7	48.2	48.4	48.8	49.4	50.0	50.8	51.4
Below Normal (10%)	51.5	51.6	51.1	50.4	49.4	49.0	49.2	49.6	50.1	50.6	51.1	51.6
Dry (16%)	51.5	51.7	51.4	50.6	49.9	49.6	49.8	50.2	50.8	51.3	51.9	52.5
Critical (27%)	53.6	53.4	52.4	51.4	50.7	50.2	50.6	51.4	52.2	53.2	54.8	55.0

Alternative 5

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	60.7	57.0	53.9	52.0	51.0	50.7	51.2	52.3	53.1	55.4	59.8	63.1
20%	56.7	55.0	52.8	51.4	50.3	50.0	50.4	51.4	52.0	53.4	54.4	55.9
30%	54.4	53.7	52.3	50.9	49.6	49.5	50.0	50.7	51.3	52.2	53.1	53.8
40%	53.2	53.1	51.9	50.4	49.4	49.1	49.8	50.3	50.8	51.5	52.1	52.8
50%	52.5	52.6	51.6	50.2	49.0	49.0	49.3	49.9	50.3	51.2	51.7	52.1
60%	52.1	52.3	51.2	49.7	48.7	48.6	48.9	49.4	49.7	50.4	50.9	51.5
70%	51.5	51.8	51.0	49.4	48.3	48.0	48.5	48.9	49.3	50.0	50.6	51.1
80%	51.1	51.3	50.2	48.9	47.3	47.3	47.6	48.1	48.5	49.5	50.1	50.7
90%	49.9	50.1	49.5	47.8	46.3	46.3	46.7	47.1	47.4	48.4	48.9	49.5
Long Term												
Full Simulation Period ^b	54.0	53.1	51.7	50.0	48.9	48.7	49.2	50.0	50.4	51.7	52.8	53.9
Water Year Types^c												
Wet (23%)	50.1	49.7	48.7	49.3	47.9	47.7	47.6	48.0	48.4	48.9	49.4	49.9
Above Normal (24%)	54.7	53.3	51.2	49.3	47.9	47.9	48.3	48.9	49.7	50.6	51.7	52.6
Below Normal (10%)	52.9	51.6	50.7	49.7	48.9	48.6	49.1	49.8	50.4	51.2	52.1	52.9
Dry (16%)	53.0	53.0	52.1	50.7	49.7	49.3	49.7	50.6	51.6	52.9	53.1	54.4
Critical (27%)	55.3	54.0	52.4	50.9	50.0	50.0	51.1	52.6	52.0	54.5	56.8	58.5

Alternative 5 minus Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	6.0	2.2	0.4	-0.1	-0.1	0.0	0.2	0.7	1.0	2.4	6.1	9.0
20%	2.9	1.1	0.1	-0.1	-0.1	-0.1	0.2	0.5	0.5	1.3	1.7	2.8
30%	1.6	0.9	0.0	0.0	-0.3	-0.1	0.1	0.3	0.4	0.8	0.8	1.3
40%	0.9	0.7	0.2	-0.3	-0.2	-0.1	0.1	0.1	0.2	0.4	0.4	0.8
50%	0.7	0.7	0.2	-0.2	-0.4	-0.1	0.0	0.2	0.1	0.5	0.4	0.5
60%	0.8	0.6	-0.1	-0.4	-0.4	-0.1	0.0	0.1	-0.1	0.1	0.2	0.4
70%	0.4	0.4	0.0	-0.3	-0.5	-0.4	-0.1	-0.1	-0.1	0.1	0.1	0.3
80%	0.5	0.4	-0.3	-0.5	-1.2	-0.7	-0.2	-0.3	-0.5	0.0	0.1	0.4
90%	0.1	0.1	-0.6	-1.3	-1.2	-0.7	-0.5	-0.4	-0.5	-0.1	-0.2	0.1
Long Term												
Full Simulation Period ^b	1.5	0.7	0.0	-0.4	-0.5	-0.3	0.0	0.4	0.1	0.8	1.0	1.7
Water Year Types^c												
Wet (23%)	1.2	0.7	0.2	-0.1	-0.3	-0.2	-0.4	-0.3	-0.3	-0.2	-0.1	0.0
Above Normal (24%)	1.6	0.5	-0.4	-0.7	-0.8	-0.3	-0.1	0.1	0.3	0.6	1.0	1.2
Below Normal (10%)	1.4	0.0	-0.4	-0.7	-0.5	-0.4	-0.1	0.1	0.3	0.6	1.0	1.3
Dry (16%)	1.5	1.3	0.7	0.1	-0.2	-0.3	-0.1	0.4	0.8	1.6	1.2	2.0
Critical (27%)	1.7	0.6	0.0	-0.6	-0.7	-0.3	0.6	1.2	-0.1	1.3	2.0	3.5

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

5C.3.2.6 Stanislaus River below Tulloch Reservoir Temperature

Table 5C.3.2.6.1 Stanislaus River below Tulloch Reservoir, Monthly Temperature

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	60.5	59.0	54.8	50.7	50.2	51.2	52.6	53.6	54.7	56.5	57.4	59.2
20%	57.4	56.6	53.3	50.3	49.5	50.6	52.1	53.0	54.1	55.0	55.7	56.7
30%	55.6	55.1	52.8	49.6	48.8	50.2	51.7	52.6	53.4	54.3	55.0	55.6
40%	55.1	54.6	52.0	49.1	48.5	49.8	51.3	52.4	52.9	53.9	54.5	55.0
50%	54.5	54.1	51.7	48.7	48.0	49.6	51.0	52.1	52.6	53.7	54.1	54.5
60%	54.1	53.9	51.4	48.3	47.8	49.3	50.6	51.6	52.2	52.8	53.5	54.0
70%	53.6	53.2	50.9	47.8	47.5	48.9	50.1	51.3	51.8	52.4	53.2	53.5
80%	53.2	52.6	50.4	47.1	46.7	48.4	49.7	51.0	51.4	51.8	52.8	53.1
90%	52.0	51.8	49.9	46.3	45.8	47.5	48.8	50.2	50.3	50.8	51.5	51.8
Long Term												
Full Simulation Period ^b	55.6	54.7	51.9	48.6	48.1	49.5	50.9	52.1	52.8	53.7	54.6	55.4
Water Year Types^c												
Wet (23%)	51.5	51.0	48.7	47.6	47.1	48.8	49.6	50.9	51.0	51.5	52.2	52.4
Above Normal (24%)	56.3	54.9	51.5	48.1	47.4	48.7	50.1	51.4	51.9	52.7	53.7	54.5
Below Normal (10%)	54.6	53.8	51.0	48.3	48.1	49.4	51.0	51.7	52.2	53.3	54.0	54.4
Dry (16%)	54.5	54.1	51.9	49.0	48.6	50.0	51.6	52.3	53.2	54.3	55.2	56.0
Critical (27%)	57.0	55.8	53.0	49.6	49.2	50.7	52.3	53.7	55.1	56.5	57.2	58.7

Revised Alternative 1

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	57.8	57.4	54.4	50.7	50.3	51.4	52.7	53.5	54.5	55.7	56.5	57.2
20%	56.0	55.9	53.4	50.0	49.6	50.7	52.0	52.8	53.8	54.8	55.3	55.7
30%	55.2	54.7	52.9	49.6	48.9	50.3	51.7	52.5	53.2	53.9	54.8	55.1
40%	54.7	54.4	51.9	49.1	48.7	49.9	51.3	52.3	53.0	53.7	54.2	54.6
50%	54.4	53.9	51.6	48.9	48.3	49.7	51.1	52.1	52.6	53.2	53.9	54.2
60%	53.9	53.4	51.4	48.4	47.9	49.4	50.8	51.7	52.2	52.7	53.4	53.6
70%	53.5	53.0	51.0	48.0	47.7	49.1	50.3	51.6	52.0	52.5	53.1	53.4
80%	53.1	52.7	50.6	47.5	47.3	48.6	49.9	51.0	51.5	51.8	52.6	52.9
90%	52.1	51.9	49.7	47.0	46.0	47.9	49.1	50.3	50.7	51.1	51.8	51.7
Long Term												
Full Simulation Period ^b	54.9	54.5	52.0	48.7	48.3	49.7	51.0	52.0	52.7	53.4	54.3	54.7
Water Year Types^c												
Wet (23%)	51.1	50.8	48.6	47.6	47.6	48.8	49.8	51.0	51.4	51.6	52.3	52.4
Above Normal (24%)	55.4	55.0	52.0	48.5	47.7	49.0	50.3	51.4	51.8	52.4	53.3	53.8
Below Normal (10%)	54.0	53.4	50.9	48.3	48.3	49.5	51.0	51.7	52.2	53.2	53.7	54.0
Dry (16%)	54.0	53.7	51.6	48.9	48.6	50.1	51.5	52.3	53.1	53.9	54.5	54.9
Critical (27%)	56.1	55.6	53.1	49.7	49.3	50.9	52.2	53.3	54.5	55.5	57.0	57.5

Revised Alternative 1 minus No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-2.7	-1.6	-0.3	0.0	0.1	0.2	0.1	-0.1	-0.2	-0.8	-0.9	-2.0
20%	-1.3	-0.7	0.1	-0.3	0.1	0.2	-0.1	-0.1	-0.3	-0.3	-0.4	-1.0
30%	-0.5	-0.4	0.0	0.0	0.1	0.1	-0.1	-0.1	-0.2	-0.3	-0.3	-0.5
40%	-0.4	-0.2	-0.1	0.1	0.2	0.1	0.0	-0.1	0.1	-0.2	-0.3	-0.4
50%	-0.2	-0.2	-0.1	0.1	0.3	0.1	0.1	0.0	0.0	-0.5	-0.2	-0.3
60%	-0.2	-0.4	0.0	0.2	0.1	0.1	0.2	0.0	-0.1	-0.1	-0.1	-0.3
70%	-0.1	-0.2	0.1	0.2	0.1	0.1	0.2	0.3	0.2	0.0	-0.1	-0.1
80%	-0.1	0.1	0.1	0.3	0.5	0.2	0.2	0.0	0.1	0.0	-0.2	-0.1
90%	0.0	0.1	-0.2	0.7	0.2	0.4	0.3	0.1	0.4	0.3	0.3	-0.1
Long Term												
Full Simulation Period ^b	-0.7	-0.2	0.1	0.1	0.2	0.1	0.1	-0.1	-0.1	-0.4	-0.3	-0.7
Water Year Types^c												
Wet (23%)	-0.4	-0.3	-0.1	0.1	0.5	0.0	0.3	0.1	0.3	0.1	0.1	0.0
Above Normal (24%)	-0.8	0.0	0.5	0.4	0.3	0.3	0.1	0.0	-0.1	-0.3	-0.5	-0.7
Below Normal (10%)	-0.6	-0.4	-0.1	0.0	0.2	0.1	0.0	0.1	0.0	-0.1	-0.3	-0.4
Dry (16%)	-0.5	-0.4	-0.2	-0.1	0.0	0.0	-0.1	0.0	-0.1	-0.4	-0.8	-1.1
Critical (27%)	-1.0	-0.2	0.0	0.1	0.1	0.2	-0.1	-0.5	-0.6	-0.9	-0.2	-1.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.6.2 Stanislaus River below Tulloch Reservoir, Monthly Temperature

Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	57.8	57.4	54.4	50.7	50.3	51.4	52.7	53.5	54.5	55.7	56.5	57.2
20%	56.0	55.9	53.4	50.0	49.6	50.7	52.0	52.8	53.8	54.8	55.3	55.7
30%	55.2	54.7	52.9	49.6	48.9	50.3	51.7	52.5	53.2	53.9	54.8	55.1
40%	54.7	54.4	51.9	49.1	48.7	49.9	51.3	52.3	53.0	53.7	54.2	54.6
50%	54.4	53.9	51.6	48.9	48.3	49.7	51.1	52.1	52.6	53.2	53.9	54.2
60%	53.9	53.4	51.4	48.4	47.9	49.4	50.8	51.7	52.2	52.7	53.4	53.6
70%	53.5	53.0	51.0	48.0	47.7	49.1	50.3	51.6	52.0	52.5	53.1	53.4
80%	53.1	52.7	50.6	47.5	47.3	48.6	49.9	51.0	51.5	51.8	52.6	52.9
90%	52.1	51.9	49.7	47.0	46.0	47.9	49.1	50.3	50.7	51.1	51.8	51.7
Long Term												
Full Simulation Period ^b	54.9	54.5	52.0	48.7	48.3	49.7	51.0	52.0	52.7	53.4	54.3	54.7
Water Year Types^c												
Wet (23%)	51.1	50.8	48.6	47.6	47.6	48.8	49.8	51.0	51.4	51.6	52.3	52.4
Above Normal (24%)	55.4	55.0	52.0	48.5	47.7	49.0	50.3	51.4	51.8	52.4	53.3	53.8
Below Normal (10%)	54.0	53.4	50.9	48.3	48.3	49.5	51.0	51.7	52.2	53.2	53.7	54.0
Dry (16%)	54.0	53.7	51.6	48.9	48.6	50.1	51.5	52.3	53.1	53.9	54.5	54.9
Critical (27%)	56.1	55.6	53.1	49.7	49.3	50.9	52.2	53.3	54.5	55.5	57.0	57.5

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	60.5	59.0	54.8	50.7	50.2	51.2	52.6	53.6	54.7	56.5	57.4	59.2
20%	57.4	56.6	53.3	50.3	49.5	50.6	52.1	53.0	54.1	55.0	55.7	56.7
30%	55.6	55.1	52.8	49.6	48.8	50.2	51.7	52.6	53.4	54.3	55.0	55.6
40%	55.1	54.6	52.0	49.1	48.5	49.8	51.3	52.4	52.9	53.9	54.5	55.0
50%	54.5	54.1	51.7	48.7	48.0	49.6	51.0	52.1	52.6	53.7	54.1	54.5
60%	54.1	53.9	51.4	48.3	47.8	49.3	50.6	51.6	52.2	52.8	53.5	54.0
70%	53.6	53.2	50.9	47.8	47.5	48.9	50.1	51.3	51.8	52.4	53.2	53.5
80%	53.2	52.6	50.4	47.1	46.7	48.4	49.7	51.0	51.4	51.8	52.8	53.1
90%	52.0	51.8	49.9	46.3	45.8	47.5	48.8	50.2	50.3	50.8	51.5	51.8
Long Term												
Full Simulation Period ^b	55.6	54.7	51.9	48.6	48.1	49.5	50.9	52.1	52.8	53.7	54.6	55.4
Water Year Types^c												
Wet (23%)	51.5	51.0	48.7	47.6	47.1	48.8	49.6	50.9	51.0	51.5	52.2	52.4
Above Normal (24%)	56.3	54.9	51.5	48.1	47.4	48.7	50.1	51.4	51.9	52.7	53.7	54.5
Below Normal (10%)	54.6	53.8	51.0	48.3	48.1	49.4	51.0	51.7	52.2	53.3	54.0	54.4
Dry (16%)	54.5	54.1	51.9	49.0	48.6	50.0	51.6	52.3	53.2	54.3	55.2	56.0
Critical (27%)	57.0	55.8	53.0	49.6	49.2	50.7	52.3	53.7	55.1	56.5	57.2	58.7

No Action Alternative minus Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2.7	1.6	0.3	0.0	-0.1	-0.2	-0.1	0.1	0.2	0.8	0.9	2.0
20%	1.3	0.7	-0.1	0.3	-0.1	-0.2	0.1	0.1	0.3	0.3	0.4	1.0
30%	0.5	0.4	0.0	0.0	-0.1	-0.1	0.1	0.1	0.2	0.3	0.3	0.5
40%	0.4	0.2	0.1	-0.1	-0.2	-0.1	0.0	0.1	-0.1	0.2	0.3	0.4
50%	0.2	0.2	0.1	-0.1	-0.3	-0.1	-0.1	0.0	0.0	0.5	0.2	0.3
60%	0.2	0.4	0.0	-0.2	-0.1	-0.1	-0.2	0.0	0.1	0.1	0.1	0.3
70%	0.1	0.2	-0.1	-0.2	-0.1	-0.1	-0.2	-0.3	-0.2	0.0	0.1	0.1
80%	0.1	-0.1	-0.1	-0.3	-0.5	-0.2	-0.2	0.0	-0.1	0.0	0.2	0.1
90%	0.0	-0.1	0.2	-0.7	-0.2	-0.4	-0.3	-0.1	-0.4	-0.3	-0.3	0.1
Long Term												
Full Simulation Period ^b	0.7	0.2	-0.1	-0.1	-0.2	-0.1	-0.1	0.1	0.1	0.4	0.3	0.7
Water Year Types^c												
Wet (23%)	0.4	0.3	0.1	-0.1	-0.5	0.0	-0.3	-0.1	-0.3	-0.1	-0.1	0.0
Above Normal (24%)	0.8	0.0	-0.5	-0.4	-0.3	-0.3	-0.1	0.0	0.1	0.3	0.5	0.7
Below Normal (10%)	0.6	0.4	0.1	0.0	-0.2	-0.1	0.0	-0.1	0.0	0.1	0.3	0.4
Dry (16%)	0.5	0.4	0.2	0.1	0.0	0.0	0.1	0.0	0.1	0.4	0.8	1.1
Critical (27%)	1.0	0.2	0.0	-0.1	-0.1	-0.2	0.1	0.5	0.6	0.9	0.2	1.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.6.3 Stanislaus River below Tulloch Reservoir, Monthly Temperature

Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	57.8	57.4	54.4	50.7	50.3	51.4	52.7	53.5	54.5	55.7	56.5	57.2
20%	56.0	55.9	53.4	50.0	49.6	50.7	52.0	52.8	53.8	54.8	55.3	55.7
30%	55.2	54.7	52.9	49.6	48.9	50.3	51.7	52.5	53.2	53.9	54.8	55.1
40%	54.7	54.4	51.9	49.1	48.7	49.9	51.3	52.3	53.0	53.7	54.2	54.6
50%	54.4	53.9	51.6	48.9	48.3	49.7	51.1	52.1	52.6	53.2	53.9	54.2
60%	53.9	53.4	51.4	48.4	47.9	49.4	50.8	51.7	52.2	52.7	53.4	53.6
70%	53.5	53.0	51.0	48.0	47.7	49.1	50.3	51.6	52.0	52.5	53.1	53.4
80%	53.1	52.7	50.6	47.5	47.3	48.6	49.9	51.0	51.5	51.8	52.6	52.9
90%	52.1	51.9	49.7	47.0	46.0	47.9	49.1	50.3	50.7	51.1	51.8	51.7
Long Term												
Full Simulation Period ^b	54.9	54.5	52.0	48.7	48.3	49.7	51.0	52.0	52.7	53.4	54.3	54.7
Water Year Types^c												
Wet (23%)	51.1	50.8	48.6	47.6	47.6	48.8	49.8	51.0	51.4	51.6	52.3	52.4
Above Normal (24%)	55.4	55.0	52.0	48.5	47.7	49.0	50.3	51.4	51.8	52.4	53.3	53.8
Below Normal (10%)	54.0	53.4	50.9	48.3	48.3	49.5	51.0	51.7	52.2	53.2	53.7	54.0
Dry (16%)	54.0	53.7	51.6	48.9	48.6	50.1	51.5	52.3	53.1	53.9	54.5	54.9
Critical (27%)	56.1	55.6	53.1	49.7	49.3	50.9	52.2	53.3	54.5	55.5	57.0	57.5

Alternative 3

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	57.8	57.5	54.3	50.8	50.3	51.3	52.7	53.5	54.5	55.7	56.4	57.3
20%	56.4	55.9	53.5	50.0	49.6	50.7	52.0	52.8	53.8	54.8	55.3	55.7
30%	55.1	54.5	52.8	49.5	49.1	50.3	51.5	52.4	53.2	54.0	54.7	55.1
40%	54.6	54.1	51.8	49.0	48.7	49.9	51.4	52.2	52.8	53.6	54.2	54.5
50%	54.2	53.7	51.5	48.7	48.2	49.7	51.0	51.9	52.5	53.3	53.8	54.1
60%	53.7	53.4	51.3	48.5	47.9	49.5	50.8	51.6	52.1	52.9	53.3	53.6
70%	53.5	53.0	50.9	48.0	47.6	49.0	50.4	51.4	51.7	52.6	53.0	53.2
80%	52.9	52.7	50.5	47.5	47.2	48.6	49.9	50.9	51.2	52.1	52.5	52.8
90%	51.9	51.8	49.6	46.8	46.2	47.8	49.2	50.1	50.7	51.3	51.7	51.7
Long Term												
Full Simulation Period ^b	54.8	54.3	51.8	48.6	48.3	49.6	51.0	51.9	52.6	53.6	54.3	54.5
Water Year Types^c												
Wet (23%)	51.0	50.7	48.5	47.6	47.7	48.8	49.8	50.8	51.3	51.8	52.2	52.3
Above Normal (24%)	55.6	55.0	51.8	48.5	47.6	48.9	50.3	51.2	51.6	52.6	53.3	53.8
Below Normal (10%)	53.9	53.3	50.8	48.5	48.3	49.5	51.0	51.6	52.3	53.2	53.7	54.0
Dry (16%)	53.8	53.5	51.5	48.9	48.6	50.0	51.5	52.2	53.0	53.9	54.4	54.9
Critical (27%)	55.8	55.3	52.9	49.6	49.2	50.9	52.3	53.3	54.5	56.1	56.9	57.2

Alternative 3 minus Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.0	0.1	-0.2	0.1	0.0	-0.1	0.0	0.0	0.1	0.0	-0.1	0.0
20%	0.4	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
30%	-0.1	-0.2	-0.1	-0.1	0.2	0.0	-0.1	-0.1	-0.1	0.1	0.0	0.0
40%	-0.1	-0.3	-0.1	-0.1	0.0	0.0	0.0	-0.1	-0.1	-0.1	0.0	-0.1
50%	-0.1	-0.2	-0.1	-0.1	-0.1	-0.1	0.0	-0.2	-0.1	0.0	-0.1	-0.2
60%	-0.1	-0.1	-0.1	0.0	-0.1	0.0	0.0	-0.1	-0.1	0.2	-0.1	0.0
70%	0.0	0.0	-0.2	0.0	-0.1	-0.1	0.1	-0.1	-0.3	0.2	0.0	-0.2
80%	-0.2	0.0	-0.1	0.0	0.0	-0.1	0.0	-0.1	-0.2	0.3	-0.1	-0.2
90%	-0.1	-0.1	-0.1	-0.2	0.2	-0.1	0.1	-0.2	0.0	0.2	-0.1	-0.1
Long Term												
Full Simulation Period ^b	-0.1	-0.1	-0.1	0.0	0.0	-0.1	0.0	-0.1	-0.1	0.3	0.0	-0.1
Water Year Types^c												
Wet (23%)	-0.1	-0.1	-0.1	0.0	0.1	0.0	0.0	-0.2	-0.1	0.2	0.0	-0.1
Above Normal (24%)	0.2	0.0	-0.2	-0.1	0.0	-0.1	0.0	-0.1	-0.2	0.2	0.0	0.0
Below Normal (10%)	-0.1	-0.1	0.0	0.2	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0
Dry (16%)	-0.1	-0.1	-0.1	-0.1	-0.1	0.0	-0.1	0.0	-0.1	0.0	0.0	0.0
Critical (27%)	-0.3	-0.2	-0.2	-0.1	-0.1	0.0	0.1	0.1	0.1	0.6	0.0	-0.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.6.4 Stanislaus River below Tulloch Reservoir, Monthly Temperature

Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	57.8	57.4	54.4	50.7	50.3	51.4	52.7	53.5	54.5	55.7	56.5	57.2
20%	56.0	55.9	53.4	50.0	49.6	50.7	52.0	52.8	53.8	54.8	55.3	55.7
30%	55.2	54.7	52.9	49.6	48.9	50.3	51.7	52.5	53.2	53.9	54.8	55.1
40%	54.7	54.4	51.9	49.1	48.7	49.9	51.3	52.3	53.0	53.7	54.2	54.6
50%	54.4	53.9	51.6	48.9	48.3	49.7	51.1	52.1	52.6	53.2	53.9	54.2
60%	53.9	53.4	51.4	48.4	47.9	49.4	50.8	51.7	52.2	52.7	53.4	53.6
70%	53.5	53.0	51.0	48.0	47.7	49.1	50.3	51.6	52.0	52.5	53.1	53.4
80%	53.1	52.7	50.6	47.5	47.3	48.6	49.9	51.0	51.5	51.8	52.6	52.9
90%	52.1	51.9	49.7	47.0	46.0	47.9	49.1	50.3	50.7	51.1	51.8	51.7
Long Term												
Full Simulation Period ^b	54.9	54.5	52.0	48.7	48.3	49.7	51.0	52.0	52.7	53.4	54.3	54.7
Water Year Types^c												
Wet (23%)	51.1	50.8	48.6	47.6	47.6	48.8	49.8	51.0	51.4	51.6	52.3	52.4
Above Normal (24%)	55.4	55.0	52.0	48.5	47.7	49.0	50.3	51.4	51.8	52.4	53.3	53.8
Below Normal (10%)	54.0	53.4	50.9	48.3	48.3	49.5	51.0	51.7	52.2	53.2	53.7	54.0
Dry (16%)	54.0	53.7	51.6	48.9	48.6	50.1	51.5	52.3	53.1	53.9	54.5	54.9
Critical (27%)	56.1	55.6	53.1	49.7	49.3	50.9	52.2	53.3	54.5	55.5	57.0	57.5

Alternative 5

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	64.5	60.2	55.1	51.0	50.0	51.1	52.9	53.9	55.2	57.1	60.8	63.2
20%	58.4	57.9	53.6	50.2	49.5	50.6	52.2	53.2	54.3	55.4	56.8	57.9
30%	56.4	55.7	52.7	49.4	48.8	50.0	51.8	52.6	53.4	54.7	55.5	56.1
40%	55.3	54.8	52.1	49.0	48.4	49.7	51.6	52.4	52.9	54.0	54.9	55.2
50%	54.7	54.2	51.8	48.7	48.0	49.5	51.0	52.2	52.6	53.7	54.2	54.6
60%	54.4	53.9	51.5	48.3	47.7	49.2	50.6	51.8	52.2	52.8	53.5	54.0
70%	53.7	53.4	50.9	47.9	47.2	48.8	50.1	51.4	51.7	52.4	53.2	53.6
80%	53.3	52.7	50.4	47.1	46.7	48.1	49.6	50.8	51.3	51.9	52.8	53.1
90%	52.1	51.8	49.8	45.9	45.6	47.4	48.7	50.1	50.1	50.7	51.4	52.0
Long Term												
Full Simulation Period ^b	56.2	55.1	52.0	48.6	48.0	49.4	50.9	52.2	52.6	53.9	55.1	56.0
Water Year Types^c												
Wet (23%)	52.0	51.3	48.8	47.6	47.0	48.7	49.5	50.8	50.9	51.4	52.1	52.4
Above Normal (24%)	57.2	55.5	51.5	48.1	47.2	48.6	50.1	51.5	51.9	52.8	54.0	54.9
Below Normal (10%)	55.4	53.7	50.9	48.1	48.0	49.2	51.0	51.8	52.4	53.6	54.5	55.1
Dry (16%)	55.1	54.7	52.2	49.2	48.7	50.0	51.7	52.6	53.4	55.0	55.7	56.5
Critical (27%)	57.4	56.3	53.1	49.6	49.1	50.6	52.6	54.1	54.5	56.5	58.5	60.3

Alternative 5 minus Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	6.7	2.8	0.7	0.3	-0.3	-0.3	0.2	0.4	0.8	1.4	4.3	6.0
20%	2.4	2.1	0.2	0.2	-0.2	-0.1	0.2	0.4	0.4	0.6	1.6	2.2
30%	1.2	1.0	-0.1	-0.2	-0.2	-0.3	0.2	0.2	0.2	0.8	0.8	1.0
40%	0.5	0.4	0.2	-0.1	-0.3	-0.2	0.2	0.2	0.0	0.3	0.6	0.6
50%	0.4	0.3	0.2	-0.2	-0.3	-0.2	-0.1	0.2	0.0	0.5	0.3	0.3
60%	0.5	0.5	0.1	-0.1	-0.2	-0.3	-0.2	0.2	0.0	0.1	0.1	0.4
70%	0.2	0.3	-0.1	-0.1	-0.4	-0.3	-0.2	-0.2	-0.3	0.0	0.1	0.3
80%	0.2	0.0	-0.2	-0.3	-0.6	-0.5	-0.3	-0.3	-0.1	0.1	0.2	0.2
90%	0.0	-0.1	0.1	-1.0	-0.4	-0.5	-0.4	-0.2	-0.6	-0.4	-0.4	0.3
Long Term												
Full Simulation Period ^b	1.3	0.6	0.0	-0.1	-0.3	-0.3	0.0	0.3	0.0	0.5	0.8	1.4
Water Year Types^c												
Wet (23%)	0.9	0.5	0.2	0.0	-0.5	-0.1	-0.3	-0.2	-0.5	-0.2	-0.1	0.0
Above Normal (24%)	1.8	0.5	-0.5	-0.4	-0.5	-0.5	-0.2	0.1	0.0	0.5	0.7	1.0
Below Normal (10%)	1.4	0.3	0.1	-0.1	-0.3	-0.2	0.0	0.1	0.1	0.4	0.7	1.1
Dry (16%)	1.1	1.0	0.6	0.2	0.1	-0.1	0.1	0.3	0.4	1.1	1.2	1.6
Critical (27%)	1.4	0.8	0.1	-0.1	-0.2	-0.3	0.3	0.8	0.0	0.9	1.5	2.8

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

5C.3.2.7 Stanislaus River below Goodwin Dam Temperature

Table 5C.3.2.7.1 Stanislaus River below Goodwin Dam, Monthly Temperature

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	60.7	59.2	54.6	51.1	50.8	51.9	53.1	54.1	55.6	57.6	58.3	60.1
20%	58.0	56.6	53.3	50.3	50.2	51.4	52.4	53.6	54.8	55.9	56.5	57.4
30%	56.1	55.5	52.5	49.7	49.5	50.8	52.1	53.0	54.0	55.1	55.8	56.4
40%	55.5	54.8	51.9	49.3	48.9	50.6	51.7	52.8	53.7	54.6	55.3	55.7
50%	55.0	54.2	51.6	48.9	48.8	50.3	51.4	52.6	53.3	54.4	54.8	55.3
60%	54.5	54.0	51.3	48.4	48.4	50.0	51.0	52.1	52.8	53.5	54.2	54.6
70%	54.0	53.5	51.0	48.0	48.0	49.8	50.6	51.8	52.5	53.2	53.9	54.2
80%	53.5	52.9	50.4	47.3	47.4	49.0	50.1	51.5	52.0	52.6	53.3	53.8
90%	52.4	52.1	49.9	46.5	46.7	48.3	49.2	50.6	50.8	51.5	52.2	52.6
Long Term												
Full Simulation Period ^b	56.0	54.9	51.9	48.8	48.7	50.2	51.3	52.5	53.5	54.6	55.3	56.1
Water Year Types^c												
Wet (23%)	51.9	51.3	48.8	47.9	47.6	49.1	50.0	51.3	51.6	52.2	52.8	53.0
Above Normal (24%)	56.7	55.2	51.5	48.4	48.0	49.6	50.6	51.9	52.5	53.5	54.5	55.2
Below Normal (10%)	55.0	54.1	51.0	48.4	48.7	50.0	51.3	52.1	52.9	54.1	54.7	55.1
Dry (16%)	54.9	54.3	51.8	49.2	49.2	50.9	51.9	52.8	53.9	55.1	56.0	56.7
Critical (27%)	57.4	56.0	52.9	49.7	49.9	51.5	52.7	54.3	56.0	57.5	58.2	59.5

Revised Alternative 1

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	58.8	57.3	54.1	50.9	50.8	52.1	53.2	54.1	55.4	56.6	57.4	57.9
20%	57.0	56.0	53.4	50.1	50.2	51.4	52.4	53.5	54.6	55.6	56.0	56.7
30%	56.2	54.9	52.9	49.8	49.5	50.9	52.1	53.0	53.9	54.8	55.4	55.8
40%	55.5	54.6	51.9	49.2	49.1	50.7	51.7	52.7	53.6	54.5	55.0	55.3
50%	55.0	54.0	51.6	49.0	48.8	50.5	51.5	52.6	53.1	54.0	54.7	55.0
60%	54.6	53.8	51.4	48.5	48.5	50.2	51.2	52.1	52.8	53.4	54.1	54.4
70%	54.2	53.3	51.0	48.1	48.3	49.9	50.8	52.0	52.5	53.2	53.8	54.0
80%	53.6	52.9	50.6	47.6	47.8	49.2	50.3	51.6	52.0	52.5	53.3	53.5
90%	52.7	52.1	49.8	47.1	46.9	48.6	49.6	50.7	51.3	51.7	52.4	52.4
Long Term												
Full Simulation Period ^b	55.6	54.6	51.9	48.9	48.9	50.4	51.4	52.5	53.3	54.1	55.0	55.4
Water Year Types^c												
Wet (23%)	51.7	51.0	48.6	47.9	48.0	49.4	50.2	51.4	51.9	52.3	52.9	53.0
Above Normal (24%)	56.2	55.1	51.9	48.7	48.4	49.9	50.7	51.9	52.4	53.1	54.0	54.5
Below Normal (10%)	54.7	53.6	50.9	48.4	48.8	50.1	51.4	52.2	52.9	53.9	54.4	54.7
Dry (16%)	54.7	53.9	51.6	49.1	49.2	50.9	51.9	52.8	53.8	54.7	55.2	55.6
Critical (27%)	56.8	55.7	52.9	49.8	50.0	51.7	52.7	53.9	55.3	56.4	57.8	58.5

Revised Alternative 1 minus No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-2.0	-1.8	-0.5	-0.1	0.0	0.2	0.1	0.0	-0.2	-1.0	-1.0	-2.2
20%	-1.0	-0.6	0.1	-0.2	0.0	0.0	0.0	-0.2	-0.2	-0.3	-0.5	-0.8
30%	0.1	-0.6	0.3	0.1	0.0	0.1	0.0	-0.1	-0.1	-0.4	-0.4	-0.5
40%	0.1	-0.2	-0.1	-0.1	0.1	0.2	0.0	-0.1	-0.1	-0.2	-0.3	-0.4
50%	0.1	-0.2	0.0	0.1	0.0	0.2	0.1	0.0	-0.2	-0.5	-0.2	-0.3
60%	0.1	-0.2	0.2	0.1	0.1	0.2	0.2	0.1	0.0	-0.1	-0.1	-0.2
70%	0.2	-0.2	0.0	0.1	0.3	0.2	0.2	0.2	0.0	0.0	-0.1	-0.2
80%	0.1	0.0	0.2	0.3	0.4	0.2	0.2	0.1	0.0	-0.1	-0.1	-0.3
90%	0.3	0.0	-0.1	0.6	0.2	0.3	0.4	0.1	0.5	0.2	0.2	-0.2
Long Term												
Full Simulation Period ^b	-0.4	-0.3	0.0	0.1	0.2	0.2	0.1	-0.1	-0.2	-0.4	-0.4	-0.6
Water Year Types^c												
Wet (23%)	-0.1	-0.3	-0.1	0.0	0.3	0.2	0.3	0.1	0.3	0.0	0.1	0.0
Above Normal (24%)	-0.5	0.0	0.5	0.4	0.3	0.4	0.2	0.0	-0.1	-0.3	-0.5	-0.6
Below Normal (10%)	-0.3	-0.4	-0.1	0.0	0.1	0.1	0.0	0.1	0.0	-0.2	-0.3	-0.4
Dry (16%)	-0.2	-0.4	-0.2	-0.1	0.0	0.0	0.0	0.0	-0.1	-0.4	-0.8	-1.1
Critical (27%)	-0.6	-0.3	0.0	0.1	0.1	0.2	0.0	-0.4	-0.7	-1.1	-0.4	-1.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.7.2 Stanislaus River below Goodwin Dam, Monthly Temperature

Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	58.8	57.3	54.1	50.9	50.8	52.1	53.2	54.1	55.4	56.6	57.4	57.9
20%	57.0	56.0	53.4	50.1	50.2	51.4	52.4	53.5	54.6	55.6	56.0	56.7
30%	56.2	54.9	52.9	49.8	49.5	50.9	52.1	53.0	53.9	54.8	55.4	55.8
40%	55.5	54.6	51.9	49.2	49.1	50.7	51.7	52.7	53.6	54.5	55.0	55.3
50%	55.0	54.0	51.6	49.0	48.8	50.5	51.5	52.6	53.1	54.0	54.7	55.0
60%	54.6	53.8	51.4	48.5	48.5	50.2	51.2	52.1	52.8	53.4	54.1	54.4
70%	54.2	53.3	51.0	48.1	48.3	49.9	50.8	52.0	52.5	53.2	53.8	54.0
80%	53.6	52.9	50.6	47.6	47.8	49.2	50.3	51.6	52.0	52.5	53.3	53.5
90%	52.7	52.1	49.8	47.1	46.9	48.6	49.6	50.7	51.3	51.7	52.4	52.4
Long Term												
Full Simulation Period ^b	55.6	54.6	51.9	48.9	48.9	50.4	51.4	52.5	53.3	54.1	55.0	55.4
Water Year Types ^c												
Wet (23%)	51.7	51.0	48.6	47.9	48.0	49.4	50.2	51.4	51.9	52.3	52.9	53.0
Above Normal (24%)	56.2	55.1	51.9	48.7	48.4	49.9	50.7	51.9	52.4	53.1	54.0	54.5
Below Normal (10%)	54.7	53.6	50.9	48.4	48.8	50.1	51.4	52.2	52.9	53.9	54.4	54.7
Dry (16%)	54.7	53.9	51.6	49.1	49.2	50.9	51.9	52.8	53.8	54.7	55.2	55.6
Critical (27%)	56.8	55.7	52.9	49.8	50.0	51.7	52.7	53.9	55.3	56.4	57.8	58.5

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	60.7	59.2	54.6	51.1	50.8	51.9	53.1	54.1	55.6	57.6	58.3	60.1
20%	58.0	56.6	53.3	50.3	50.2	51.4	52.4	53.6	54.8	55.9	56.5	57.4
30%	56.1	55.5	52.5	49.7	49.5	50.8	52.1	53.0	54.0	55.1	55.8	56.4
40%	55.5	54.8	51.9	49.3	48.9	50.6	51.7	52.8	53.7	54.6	55.3	55.7
50%	55.0	54.2	51.6	48.9	48.8	50.3	51.4	52.6	53.3	54.4	54.8	55.3
60%	54.5	54.0	51.3	48.4	48.4	50.0	51.0	52.1	52.8	53.5	54.2	54.6
70%	54.0	53.5	51.0	48.0	48.0	49.8	50.6	51.8	52.5	53.2	53.9	54.2
80%	53.5	52.9	50.4	47.3	47.4	49.0	50.1	51.5	52.0	52.6	53.3	53.8
90%	52.4	52.1	49.9	46.5	46.7	48.3	49.2	50.6	50.8	51.5	52.2	52.6
Long Term												
Full Simulation Period ^b	56.0	54.9	51.9	48.8	48.7	50.2	51.3	52.5	53.5	54.6	55.3	56.1
Water Year Types ^c												
Wet (23%)	51.9	51.3	48.8	47.9	47.6	49.1	50.0	51.3	51.6	52.2	52.8	53.0
Above Normal (24%)	56.7	55.2	51.5	48.4	48.0	49.6	50.6	51.9	52.5	53.5	54.5	55.2
Below Normal (10%)	55.0	54.1	51.0	48.4	48.7	50.0	51.3	52.1	52.9	54.1	54.7	55.1
Dry (16%)	54.9	54.3	51.8	49.2	49.2	50.9	51.9	52.8	53.9	55.1	56.0	56.7
Critical (27%)	57.4	56.0	52.9	49.7	49.9	51.5	52.7	54.3	56.0	57.5	58.2	59.5

No Action Alternative minus Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	2.0	1.8	0.5	0.1	0.0	-0.2	-0.1	0.0	0.2	1.0	1.0	2.2
20%	1.0	0.6	-0.1	0.2	0.0	0.0	0.0	0.2	0.2	0.3	0.5	0.8
30%	-0.1	0.6	-0.3	-0.1	0.0	-0.1	0.0	0.1	0.1	0.4	0.4	0.5
40%	-0.1	0.2	0.1	0.1	-0.1	-0.2	0.0	0.1	0.1	0.2	0.3	0.4
50%	-0.1	0.2	0.0	-0.1	0.0	-0.2	-0.1	0.0	0.2	0.5	0.2	0.3
60%	-0.1	0.2	-0.2	-0.1	-0.1	-0.2	-0.2	-0.1	0.0	0.1	0.1	0.2
70%	-0.2	0.2	0.0	-0.1	-0.3	-0.2	-0.2	-0.2	0.0	0.0	0.1	0.2
80%	-0.1	0.0	-0.2	-0.3	-0.4	-0.2	-0.2	-0.1	0.0	0.1	0.1	0.3
90%	-0.3	0.0	0.1	-0.6	-0.2	-0.3	-0.4	-0.1	-0.5	-0.2	-0.2	0.2
Long Term												
Full Simulation Period ^b	0.4	0.3	0.0	-0.1	-0.2	-0.2	-0.1	0.1	0.2	0.4	0.4	0.6
Water Year Types ^c												
Wet (23%)	0.1	0.3	0.1	0.0	-0.3	-0.2	-0.3	-0.1	-0.3	0.0	-0.1	0.0
Above Normal (24%)	0.5	0.0	-0.5	-0.4	-0.3	-0.4	-0.2	0.0	0.1	0.3	0.5	0.6
Below Normal (10%)	0.3	0.4	0.1	0.0	-0.1	-0.1	0.0	-0.1	0.0	0.2	0.3	0.4
Dry (16%)	0.2	0.4	0.2	0.1	0.0	0.0	0.0	0.0	0.1	0.4	0.8	1.1
Critical (27%)	0.6	0.3	0.0	-0.1	-0.1	-0.2	0.0	0.4	0.7	1.1	0.4	1.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.7.3 Stanislaus River below Goodwin Dam, Monthly Temperature

Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	58.8	57.3	54.1	50.9	50.8	52.1	53.2	54.1	55.4	56.6	57.4	57.9
20%	57.0	56.0	53.4	50.1	50.2	51.4	52.4	53.5	54.6	55.6	56.0	56.7
30%	56.2	54.9	52.9	49.8	49.5	50.9	52.1	53.0	53.9	54.8	55.4	55.8
40%	55.5	54.6	51.9	49.2	49.1	50.7	51.7	52.7	53.6	54.5	55.0	55.3
50%	55.0	54.0	51.6	49.0	48.8	50.5	51.5	52.6	53.1	54.0	54.7	55.0
60%	54.6	53.8	51.4	48.5	48.5	50.2	51.2	52.1	52.8	53.4	54.1	54.4
70%	54.2	53.3	51.0	48.1	48.3	49.9	50.8	52.0	52.5	53.2	53.8	54.0
80%	53.6	52.9	50.6	47.6	47.8	49.2	50.3	51.6	52.0	52.5	53.3	53.5
90%	52.7	52.1	49.8	47.1	46.9	48.6	49.6	50.7	51.3	51.7	52.4	52.4
Long Term												
Full Simulation Period ^b	55.6	54.6	51.9	48.9	48.9	50.4	51.4	52.5	53.3	54.1	55.0	55.4
Water Year Types^c												
Wet (23%)	51.7	51.0	48.6	47.9	48.0	49.4	50.2	51.4	51.9	52.3	52.9	53.0
Above Normal (24%)	56.2	55.1	51.9	48.7	48.4	49.9	50.7	51.9	52.4	53.1	54.0	54.5
Below Normal (10%)	54.7	53.6	50.9	48.4	48.8	50.1	51.4	52.2	52.9	53.9	54.4	54.7
Dry (16%)	54.7	53.9	51.6	49.1	49.2	50.9	51.9	52.8	53.8	54.7	55.2	55.6
Critical (27%)	56.8	55.7	52.9	49.8	50.0	51.7	52.7	53.9	55.3	56.4	57.8	58.5

Alternative 3

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	58.5	57.6	54.1	50.9	50.8	52.1	53.1	54.0	55.3	56.7	57.3	58.2
20%	57.0	56.0	53.3	50.1	50.1	51.4	52.4	53.5	54.7	55.6	56.0	56.6
30%	56.0	54.7	52.8	49.7	49.5	50.9	52.0	52.9	53.9	54.8	55.4	55.9
40%	55.2	54.3	51.7	49.1	49.1	50.7	51.7	52.6	53.5	54.4	54.9	55.2
50%	54.8	53.9	51.5	48.9	48.8	50.4	51.4	52.4	53.2	54.0	54.5	54.8
60%	54.5	53.7	51.3	48.6	48.5	50.1	51.2	52.1	52.8	53.6	54.0	54.4
70%	54.1	53.2	50.8	48.1	48.1	49.8	50.8	51.9	52.5	53.3	53.7	53.9
80%	53.4	52.9	50.5	47.7	47.7	49.0	50.3	51.4	52.0	52.9	53.2	53.4
90%	52.6	52.1	49.7	47.1	46.9	48.6	49.6	50.6	51.4	51.9	52.4	52.4
Long Term												
Full Simulation Period ^b	55.5	54.5	51.8	48.8	48.9	50.4	51.4	52.4	53.4	54.4	55.0	55.3
Water Year Types^c												
Wet (23%)	51.6	50.9	48.6	48.0	48.1	49.3	50.2	51.3	51.9	52.5	52.9	52.9
Above Normal (24%)	56.3	55.2	51.8	48.7	48.3	49.7	50.7	51.7	52.4	53.4	54.0	54.5
Below Normal (10%)	54.6	53.6	50.9	48.6	48.8	50.1	51.3	52.1	53.0	54.0	54.4	54.7
Dry (16%)	54.5	53.8	51.4	49.0	49.2	50.9	51.9	52.7	53.8	54.7	55.2	55.6
Critical (27%)	56.5	55.5	52.8	49.7	49.9	51.6	52.7	53.9	55.4	57.0	57.8	57.9

Alternative 3 minus Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-0.2	0.3	0.0	0.0	0.0	0.0	-0.1	0.0	-0.1	0.1	-0.1	0.3
20%	0.0	0.0	-0.1	0.0	-0.1	0.0	0.0	0.0	0.1	0.1	0.0	0.0
30%	-0.3	-0.2	0.0	-0.1	0.0	0.0	-0.1	-0.1	0.0	0.0	0.0	0.1
40%	-0.3	-0.2	-0.1	-0.1	0.1	0.0	0.0	-0.1	-0.1	0.0	-0.1	-0.1
50%	-0.2	-0.1	-0.1	-0.1	0.0	-0.1	-0.1	-0.2	0.1	0.0	-0.1	-0.2
60%	-0.1	-0.1	-0.1	0.1	0.0	-0.1	0.0	-0.1	0.0	0.2	0.0	0.0
70%	-0.1	0.0	-0.2	0.0	-0.2	-0.1	0.0	-0.1	0.0	0.2	-0.1	-0.2
80%	-0.2	0.0	-0.1	0.1	-0.1	-0.2	0.0	-0.1	-0.1	0.4	-0.1	-0.1
90%	-0.1	0.0	-0.1	0.0	0.0	0.0	0.0	-0.2	0.1	0.2	0.0	0.0
Long Term												
Full Simulation Period ^b	-0.1	-0.1	-0.1	0.0	0.0	-0.1	0.0	-0.1	0.0	0.3	0.0	-0.2
Water Year Types^c												
Wet (23%)	-0.1	-0.1	-0.1	0.0	0.1	0.0	0.0	-0.2	0.0	0.2	0.0	-0.1
Above Normal (24%)	0.1	0.1	-0.1	-0.1	-0.1	-0.2	0.0	-0.1	0.0	0.3	0.0	0.0
Below Normal (10%)	-0.1	-0.1	0.0	0.2	0.0	0.0	0.0	-0.1	0.1	0.0	0.0	0.0
Dry (16%)	-0.2	-0.1	-0.1	-0.1	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0
Critical (27%)	-0.4	-0.2	-0.1	-0.1	-0.1	-0.1	0.0	0.1	0.1	0.6	0.0	-0.6

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.7.4 Stanislaus River below Goodwin Dam, Monthly Temperature

Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	58.8	57.3	54.1	50.9	50.8	52.1	53.2	54.1	55.4	56.6	57.4	57.9
20%	57.0	56.0	53.4	50.1	50.2	51.4	52.4	53.5	54.6	55.6	56.0	56.7
30%	56.2	54.9	52.9	49.8	49.5	50.9	52.1	53.0	53.9	54.8	55.4	55.8
40%	55.5	54.6	51.9	49.2	49.1	50.7	51.7	52.7	53.6	54.5	55.0	55.3
50%	55.0	54.0	51.6	49.0	48.8	50.5	51.5	52.6	53.1	54.0	54.7	55.0
60%	54.6	53.8	51.4	48.5	48.5	50.2	51.2	52.1	52.8	53.4	54.1	54.4
70%	54.2	53.3	51.0	48.1	48.3	49.9	50.8	52.0	52.5	53.2	53.8	54.0
80%	53.6	52.9	50.6	47.6	47.8	49.2	50.3	51.6	52.0	52.5	53.3	53.5
90%	52.7	52.1	49.8	47.1	46.9	48.6	49.6	50.7	51.3	51.7	52.4	52.4
Long Term												
Full Simulation Period ^b	55.6	54.6	51.9	48.9	48.9	50.4	51.4	52.5	53.3	54.1	55.0	55.4
Water Year Types^c												
Wet (23%)	51.7	51.0	48.6	47.9	48.0	49.4	50.2	51.4	51.9	52.3	52.9	53.0
Above Normal (24%)	56.2	55.1	51.9	48.7	48.4	49.9	50.7	51.9	52.4	53.1	54.0	54.5
Below Normal (10%)	54.7	53.6	50.9	48.4	48.8	50.1	51.4	52.2	52.9	53.9	54.4	54.7
Dry (16%)	54.7	53.9	51.6	49.1	49.2	50.9	51.9	52.8	53.8	54.7	55.2	55.6
Critical (27%)	56.8	55.7	52.9	49.8	50.0	51.7	52.7	53.9	55.3	56.4	57.8	58.5

Alternative 5

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	64.8	60.4	54.8	51.2	50.7	51.9	53.2	54.3	56.3	58.3	61.3	64.0
20%	58.8	58.0	53.4	50.3	50.2	51.3	52.5	53.7	55.1	56.6	57.6	58.7
30%	56.7	56.0	52.7	49.6	49.4	50.8	52.2	53.0	54.2	55.6	56.3	56.9
40%	55.7	54.9	52.0	49.1	48.9	50.5	51.9	52.9	53.8	54.7	55.6	55.9
50%	55.2	54.4	51.6	48.9	48.8	50.1	51.4	52.7	53.2	54.5	54.9	55.3
60%	54.8	54.1	51.5	48.4	48.3	49.9	51.0	52.2	52.8	53.5	54.2	54.7
70%	54.2	53.6	50.9	48.0	47.8	49.5	50.6	51.8	52.2	53.2	53.9	54.3
80%	53.6	53.0	50.5	47.3	47.4	48.9	50.0	51.2	52.0	52.6	53.4	53.7
90%	52.5	52.1	49.7	46.2	46.7	48.2	49.1	50.5	50.7	51.5	52.2	52.7
Long Term												
Full Simulation Period ^b	56.6	55.3	52.0	48.8	48.6	50.1	51.3	52.7	53.4	54.8	55.9	56.7
Water Year Types^c												
Wet (23%)	52.4	51.5	48.9	47.9	47.6	49.1	49.9	51.2	51.5	52.1	52.8	53.1
Above Normal (24%)	57.6	55.7	51.5	48.3	47.9	49.5	50.5	51.9	52.5	53.6	54.7	55.6
Below Normal (10%)	55.8	53.9	50.9	48.3	48.6	49.9	51.3	52.2	53.0	54.3	55.1	55.7
Dry (16%)	55.5	54.9	52.1	49.3	49.3	50.8	52.0	53.0	54.2	55.8	56.4	57.2
Critical (27%)	57.8	56.5	53.0	49.7	49.8	51.3	52.9	54.6	55.6	57.6	59.5	61.0

Alternative 5 minus Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	6.0	3.1	0.7	0.3	-0.2	-0.2	0.0	0.2	0.9	1.7	4.0	6.0
20%	1.8	2.0	0.0	0.2	0.0	-0.1	0.1	0.3	0.5	1.0	1.6	2.0
30%	0.5	1.1	-0.2	-0.1	-0.1	-0.1	0.1	0.0	0.3	0.8	0.8	1.1
40%	0.2	0.4	0.1	-0.1	-0.1	-0.3	0.1	0.1	0.2	0.2	0.6	0.6
50%	0.2	0.4	0.1	-0.1	-0.1	-0.4	-0.1	0.1	0.1	0.5	0.2	0.3
60%	0.2	0.3	0.0	-0.1	-0.2	-0.3	-0.2	0.0	0.0	0.2	0.1	0.4
70%	0.0	0.4	-0.1	0.0	-0.4	-0.4	-0.2	-0.2	-0.3	0.0	0.2	0.3
80%	0.0	0.1	-0.1	-0.4	-0.4	-0.3	-0.3	-0.3	0.0	0.1	0.2	0.2
90%	-0.2	0.0	-0.1	-0.9	-0.2	-0.5	-0.5	-0.2	-0.6	-0.2	-0.2	0.3
Long Term												
Full Simulation Period ^b	1.0	0.6	0.1	-0.1	-0.3	-0.3	-0.1	0.2	0.1	0.6	0.9	1.3
Water Year Types^c												
Wet (23%)	0.7	0.5	0.2	0.0	-0.4	-0.3	-0.3	-0.2	-0.4	-0.2	-0.1	0.1
Above Normal (24%)	1.4	0.6	-0.4	-0.4	-0.5	-0.5	-0.2	0.0	0.1	0.5	0.7	1.0
Below Normal (10%)	1.1	0.3	0.0	-0.1	-0.2	-0.2	-0.1	0.1	0.1	0.4	0.7	1.0
Dry (16%)	0.8	1.0	0.5	0.2	0.1	-0.1	0.0	0.2	0.4	1.1	1.2	1.5
Critical (27%)	1.0	0.8	0.1	-0.1	-0.2	-0.4	0.2	0.7	0.3	1.2	1.7	2.5

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

5C.3.2.8 Stanislaus River at Orange Blossom Bridge Temperature

Table 5C.3.2.8.1. Stanislaus River at Orange Blossom Bridge, Monthly Temperature

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	61.6	58.7	53.5	51.3	52.5	55.8	55.3	57.7	63.9	65.6	65.4	64.5
20%	59.3	56.9	52.6	50.8	51.7	55.1	54.8	56.8	62.5	64.6	64.2	63.3
30%	57.6	56.2	52.3	50.1	51.2	54.6	54.1	56.0	61.6	64.1	63.4	62.0
40%	56.8	55.1	51.5	49.6	50.7	54.0	53.6	55.3	60.7	63.7	62.9	61.7
50%	56.4	54.9	51.1	49.1	50.3	53.7	53.1	55.0	59.3	63.2	62.5	61.2
60%	55.9	54.6	50.7	48.8	50.1	53.2	52.7	54.4	56.6	62.6	62.2	60.7
70%	55.2	54.1	50.5	48.4	49.6	52.1	52.2	53.9	55.9	62.1	61.9	60.4
80%	54.9	53.7	50.2	47.9	49.2	51.0	51.9	53.6	55.3	61.5	61.5	59.9
90%	54.0	52.7	49.8	47.1	48.4	49.7	50.8	52.6	54.4	58.6	59.8	58.2
Long Term												
Full Simulation Period ^b	57.2	55.3	51.4	49.2	50.4	53.2	53.2	55.1	59.0	62.9	62.7	61.5
Water Year Types^c												
Wet (23%)	53.1	51.8	48.6	48.7	49.3	50.2	51.3	53.2	55.2	59.5	59.4	57.8
Above Normal (24%)	57.9	55.5	51.2	49.0	49.9	52.7	52.4	54.5	56.3	61.9	62.2	61.1
Below Normal (10%)	56.2	54.7	50.7	48.9	50.3	53.4	52.9	54.2	58.8	63.3	62.4	61.0
Dry (16%)	56.3	55.0	51.1	49.5	50.9	54.5	54.0	55.4	61.2	64.2	63.5	62.4
Critical (27%)	58.6	56.2	52.1	49.8	51.6	55.2	55.2	57.4	63.4	65.9	65.5	64.6

Revised Alternative 1

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	62.9	57.4	53.0	51.1	52.6	56.7	56.1	58.0	63.1	65.2	64.6	63.3
20%	61.5	56.4	52.6	50.6	51.7	55.8	55.4	57.4	62.6	64.3	63.6	62.4
30%	61.0	55.5	52.0	50.0	51.2	55.2	54.9	56.5	62.1	63.8	63.0	61.9
40%	59.5	55.0	51.5	49.6	50.8	54.4	54.2	56.0	61.5	63.5	62.7	61.4
50%	59.0	54.6	51.1	49.1	50.5	53.7	53.5	55.5	59.2	63.1	62.4	60.9
60%	57.9	54.3	50.8	49.0	50.0	53.3	53.2	54.8	56.4	62.6	62.1	60.6
70%	56.8	54.0	50.6	48.4	49.8	52.5	52.6	54.3	55.8	62.1	61.8	60.0
80%	56.4	53.5	50.3	48.0	49.3	51.6	51.9	53.8	55.1	61.5	61.5	59.5
90%	55.7	52.8	49.9	47.5	48.4	50.3	51.2	52.9	53.9	58.6	60.4	57.9
Long Term												
Full Simulation Period ^b	59.2	55.1	51.4	49.3	50.5	53.8	53.8	55.5	58.9	62.4	62.3	60.9
Water Year Types^c												
Wet (23%)	54.9	51.5	48.5	48.7	49.1	51.1	51.6	53.4	54.8	59.2	59.1	57.3
Above Normal (24%)	59.8	55.3	51.4	49.3	50.3	53.2	52.9	54.9	56.1	61.7	62.0	60.7
Below Normal (10%)	58.0	54.2	50.6	48.9	50.1	53.1	53.2	54.7	59.4	63.3	62.2	60.7
Dry (16%)	58.4	54.6	51.0	49.4	50.7	54.9	54.7	55.9	61.7	64.0	63.0	61.6
Critical (27%)	60.6	56.0	52.1	49.8	51.9	56.4	56.0	57.8	63.0	64.7	64.8	64.0

Revised Alternative 1 minus No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1.3	-1.3	-0.5	-0.2	0.1	1.0	0.9	0.3	-0.8	-0.3	-0.8	-1.2
20%	2.1	-0.5	0.0	-0.1	0.0	0.8	0.6	0.5	0.1	-0.3	-0.6	-0.8
30%	3.5	-0.6	-0.4	-0.1	0.0	0.6	0.8	0.5	0.5	-0.3	-0.4	-0.2
40%	2.7	0.0	0.1	0.0	0.1	0.4	0.5	0.7	0.8	-0.2	-0.2	-0.3
50%	2.6	-0.3	0.0	0.0	0.1	0.0	0.4	0.5	0.0	-0.1	-0.1	-0.3
60%	2.1	-0.3	0.1	0.2	0.0	0.0	0.5	0.4	-0.3	-0.1	-0.1	-0.2
70%	1.6	-0.1	0.1	0.1	0.1	0.4	0.4	0.4	-0.1	0.0	0.0	-0.4
80%	1.5	-0.1	0.1	0.2	0.1	0.7	0.1	0.2	-0.2	-0.1	0.0	-0.4
90%	1.7	0.1	0.1	0.4	0.1	0.7	0.4	0.3	-0.5	0.0	0.5	-0.2
Long Term												
Full Simulation Period ^b	1.9	-0.3	0.0	0.1	0.1	0.7	0.6	0.4	-0.1	-0.5	-0.4	-0.5
Water Year Types^c												
Wet (23%)	1.8	-0.3	-0.1	0.0	-0.2	0.9	0.3	0.2	-0.4	-0.3	-0.3	-0.5
Above Normal (24%)	1.9	-0.1	0.2	0.3	0.4	0.5	0.5	0.3	-0.2	-0.2	-0.2	-0.4
Below Normal (10%)	1.8	-0.5	-0.1	0.0	-0.2	-0.3	0.4	0.5	0.6	0.0	-0.1	-0.4
Dry (16%)	2.1	-0.4	-0.1	-0.1	-0.2	0.3	0.8	0.5	0.5	-0.2	-0.6	-0.7
Critical (27%)	2.0	-0.2	0.0	0.0	0.2	1.2	0.8	0.3	-0.4	-1.2	-0.7	-0.6

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.8.2 Stanislaus River at Orange Blossom Bridge, Monthly Temperature

Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	62.9	57.4	53.0	51.1	52.6	56.7	56.1	58.0	63.1	65.2	64.6	63.3
20%	61.5	56.4	52.6	50.6	51.7	55.8	55.4	57.4	62.6	64.3	63.6	62.4
30%	61.0	55.5	52.0	50.0	51.2	55.2	54.9	56.5	62.1	63.8	63.0	61.9
40%	59.5	55.0	51.5	49.6	50.8	54.4	54.2	56.0	61.5	63.5	62.7	61.4
50%	59.0	54.6	51.1	49.1	50.5	53.7	53.5	55.5	59.2	63.1	62.4	60.9
60%	57.9	54.3	50.8	49.0	50.0	53.3	53.2	54.8	56.4	62.6	62.1	60.6
70%	56.8	54.0	50.6	48.4	49.8	52.5	52.6	54.3	55.8	62.1	61.8	60.0
80%	56.4	53.5	50.3	48.0	49.3	51.6	51.9	53.8	55.1	61.5	61.5	59.5
90%	55.7	52.8	49.9	47.5	48.4	50.3	51.2	52.9	53.9	58.6	60.4	57.9
Long Term												
Full Simulation Period ^b	59.2	55.1	51.4	49.3	50.5	53.8	53.8	55.5	58.9	62.4	62.3	60.9
Water Year Types^c												
Wet (23%)	54.9	51.5	48.5	48.7	49.1	51.1	51.6	53.4	54.8	59.2	59.1	57.3
Above Normal (24%)	59.8	55.3	51.4	49.3	50.3	53.2	52.9	54.9	56.1	61.7	62.0	60.7
Below Normal (10%)	58.0	54.2	50.6	48.9	50.1	53.1	53.2	54.7	59.4	63.3	62.2	60.7
Dry (16%)	58.4	54.6	51.0	49.4	50.7	54.9	54.7	55.9	61.7	64.0	63.0	61.6
Critical (27%)	60.6	56.0	52.1	49.8	51.9	56.4	56.0	57.8	63.0	64.7	64.8	64.0

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	61.6	58.7	53.5	51.3	52.5	55.8	55.3	57.7	63.9	65.6	65.4	64.5
20%	59.3	56.9	52.6	50.8	51.7	55.1	54.8	56.8	62.5	64.6	64.2	63.3
30%	57.6	56.2	52.3	50.1	51.2	54.6	54.1	56.0	61.6	64.1	63.4	62.0
40%	56.8	55.1	51.5	49.6	50.7	54.0	53.6	55.3	60.7	63.7	62.9	61.7
50%	56.4	54.9	51.1	49.1	50.3	53.7	53.1	55.0	59.3	63.2	62.5	61.2
60%	55.9	54.6	50.7	48.8	50.1	53.2	52.7	54.4	56.6	62.6	62.2	60.7
70%	55.2	54.1	50.5	48.4	49.6	52.1	52.2	53.9	55.9	62.1	61.9	60.4
80%	54.9	53.7	50.2	47.9	49.2	51.0	51.9	53.6	55.3	61.5	61.5	59.9
90%	54.0	52.7	49.8	47.1	48.4	49.7	50.8	52.6	54.4	58.6	59.8	58.2
Long Term												
Full Simulation Period ^b	57.2	55.3	51.4	49.2	50.4	53.2	53.2	55.1	59.0	62.9	62.7	61.5
Water Year Types^c												
Wet (23%)	53.1	51.8	48.6	48.7	49.3	50.2	51.3	53.2	55.2	59.5	59.4	57.8
Above Normal (24%)	57.9	55.5	51.2	49.0	49.9	52.7	52.4	54.5	56.3	61.9	62.2	61.1
Below Normal (10%)	56.2	54.7	50.7	48.9	50.3	53.4	52.9	54.2	58.8	63.3	62.4	61.0
Dry (16%)	56.3	55.0	51.1	49.5	50.9	54.5	54.0	55.4	61.2	64.2	63.5	62.4
Critical (27%)	58.6	56.2	52.1	49.8	51.6	55.2	55.2	57.4	63.4	65.9	65.5	64.6

No Action Alternative minus Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-1.3	1.3	0.5	0.2	-0.1	-1.0	-0.9	-0.3	0.8	0.3	0.8	1.2
20%	-2.1	0.5	0.0	0.1	0.0	-0.8	-0.6	-0.5	-0.1	0.3	0.6	0.8
30%	-3.5	0.6	0.4	0.1	0.0	-0.6	-0.8	-0.5	-0.5	0.3	0.4	0.2
40%	-2.7	0.0	-0.1	0.0	-0.1	-0.4	-0.5	-0.7	-0.8	0.2	0.2	0.3
50%	-2.6	0.3	0.0	0.0	-0.1	0.0	-0.4	-0.5	0.0	0.1	0.1	0.3
60%	-2.1	0.3	-0.1	-0.2	0.0	0.0	-0.5	-0.4	0.3	0.1	0.1	0.2
70%	-1.6	0.1	-0.1	-0.1	-0.1	-0.4	-0.4	-0.4	0.1	0.0	0.0	0.4
80%	-1.5	0.1	-0.1	-0.2	-0.1	-0.7	-0.1	-0.2	0.2	0.1	0.0	0.4
90%	-1.7	-0.1	-0.1	-0.4	-0.1	-0.7	-0.4	-0.3	0.5	0.0	-0.5	0.2
Long Term												
Full Simulation Period ^b	-1.9	0.3	0.0	-0.1	-0.1	-0.7	-0.6	-0.4	0.1	0.5	0.4	0.5
Water Year Types^c												
Wet (23%)	-1.8	0.3	0.1	0.0	0.2	-0.9	-0.3	-0.2	0.4	0.3	0.3	0.5
Above Normal (24%)	-1.9	0.1	-0.2	-0.3	-0.4	-0.5	-0.5	-0.3	0.2	0.2	0.2	0.4
Below Normal (10%)	-1.8	0.5	0.1	0.0	0.2	0.3	-0.4	-0.5	-0.6	0.0	0.1	0.4
Dry (16%)	-2.1	0.4	0.1	0.1	0.2	-0.3	-0.8	-0.5	-0.5	0.2	0.6	0.7
Critical (27%)	-2.0	0.2	0.0	0.0	-0.2	-1.2	-0.8	-0.3	0.4	1.2	0.7	0.6

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.8.3 Stanislaus River at Orange Blossom Bridge, Monthly Temperature

Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	62.9	57.4	53.0	51.1	52.6	56.7	56.1	58.0	63.1	65.2	64.6	63.3
20%	61.5	56.4	52.6	50.6	51.7	55.8	55.4	57.4	62.6	64.3	63.6	62.4
30%	61.0	55.5	52.0	50.0	51.2	55.2	54.9	56.5	62.1	63.8	63.0	61.9
40%	59.5	55.0	51.5	49.6	50.8	54.4	54.2	56.0	61.5	63.5	62.7	61.4
50%	59.0	54.6	51.1	49.1	50.5	53.7	53.5	55.5	59.2	63.1	62.4	60.9
60%	57.9	54.3	50.8	49.0	50.0	53.3	53.2	54.8	56.4	62.6	62.1	60.6
70%	56.8	54.0	50.6	48.4	49.8	52.5	52.6	54.3	55.8	62.1	61.8	60.0
80%	56.4	53.5	50.3	48.0	49.3	51.6	51.9	53.8	55.1	61.5	61.5	59.5
90%	55.7	52.8	49.9	47.5	48.4	50.3	51.2	52.9	53.9	58.6	60.4	57.9
Long Term												
Full Simulation Period ^b	59.2	55.1	51.4	49.3	50.5	53.8	53.8	55.5	58.9	62.4	62.3	60.9
Water Year Types^c												
Wet (23%)	54.9	51.5	48.5	48.7	49.1	51.1	51.6	53.4	54.8	59.2	59.1	57.3
Above Normal (24%)	59.8	55.3	51.4	49.3	50.3	53.2	52.9	54.9	56.1	61.7	62.0	60.7
Below Normal (10%)	58.0	54.2	50.6	48.9	50.1	53.1	53.2	54.7	59.4	63.3	62.2	60.7
Dry (16%)	58.4	54.6	51.0	49.4	50.7	54.9	54.7	55.9	61.7	64.0	63.0	61.6
Critical (27%)	60.6	56.0	52.1	49.8	51.9	56.4	56.0	57.8	63.0	64.7	64.8	64.0

Alternative 3

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	61.3	57.6	53.2	51.0	52.9	55.8	55.5	57.8	63.9	65.8	64.8	63.5
20%	60.0	56.6	52.7	50.7	51.9	55.2	54.8	56.7	63.2	64.8	63.8	62.6
30%	59.2	55.4	52.2	50.2	51.3	54.6	54.3	56.2	62.6	64.2	63.1	62.1
40%	58.3	54.8	51.6	49.5	50.9	54.1	53.8	55.6	62.1	63.9	62.8	61.4
50%	57.9	54.5	51.1	49.2	50.5	53.7	53.2	55.2	61.7	63.5	62.4	61.1
60%	57.4	54.1	50.9	48.8	50.1	53.4	52.8	54.7	61.3	63.3	62.1	60.8
70%	56.8	53.9	50.5	48.5	49.7	52.6	52.5	54.4	60.8	63.1	61.9	60.3
80%	56.4	53.5	50.2	48.2	49.4	51.6	51.8	53.8	60.3	62.7	61.6	60.0
90%	55.4	52.9	49.9	47.5	48.5	50.5	51.1	53.1	59.0	61.4	60.4	55.8
Long Term												
Full Simulation Period ^b	58.3	55.0	51.4	49.3	50.6	53.4	53.4	55.3	61.3	63.3	62.4	60.8
Water Year Types^c												
Wet (23%)	54.3	51.4	48.5	48.8	49.3	51.2	51.6	53.5	58.0	59.6	59.0	57.3
Above Normal (24%)	58.8	55.4	51.4	49.3	50.2	52.8	52.5	54.6	61.2	63.1	62.2	60.8
Below Normal (10%)	57.5	54.2	50.6	48.8	50.2	53.2	53.1	54.8	61.3	63.5	62.2	60.9
Dry (16%)	57.6	54.4	51.0	49.4	51.0	54.5	54.2	56.0	62.5	64.2	62.9	61.6
Critical (27%)	59.4	55.8	52.1	49.8	52.0	55.4	55.3	57.4	63.6	65.9	65.1	63.4

Alternative 3 minus Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-1.6	0.2	0.2	-0.1	0.3	-1.0	-0.7	-0.2	0.9	0.6	0.2	0.1
20%	-1.5	0.1	0.1	0.1	0.3	-0.6	-0.6	-0.7	0.5	0.5	0.2	0.2
30%	-1.8	-0.2	0.3	0.1	0.1	-0.6	-0.6	-0.2	0.5	0.4	0.1	0.2
40%	-1.3	-0.2	0.0	-0.1	0.1	-0.3	-0.4	-0.4	0.6	0.4	0.1	0.0
50%	-1.1	-0.1	-0.1	0.0	0.0	0.0	-0.2	-0.3	2.5	0.4	0.0	0.1
60%	-0.5	-0.2	0.1	-0.1	0.1	0.1	-0.4	-0.1	4.9	0.7	0.0	0.2
70%	0.0	-0.2	-0.1	0.1	-0.1	0.1	-0.1	0.1	5.0	1.0	0.1	0.3
80%	0.0	0.0	-0.1	0.1	0.1	0.0	-0.1	0.0	5.2	1.3	0.1	0.5
90%	-0.3	0.1	0.0	0.0	0.0	0.2	-0.1	0.2	5.1	2.8	0.1	-2.1
Long Term												
Full Simulation Period ^b	-0.9	-0.1	0.0	0.0	0.1	-0.4	-0.4	-0.1	2.4	0.8	0.1	-0.1
Water Year Types^c												
Wet (23%)	-0.5	-0.1	0.0	0.1	0.2	0.1	0.0	0.1	3.1	0.4	-0.1	0.0
Above Normal (24%)	-1.0	0.0	0.1	0.0	0.0	-0.3	-0.3	-0.3	5.1	1.5	0.1	0.2
Below Normal (10%)	-0.5	0.0	0.0	0.0	0.1	0.1	-0.1	0.1	1.9	0.2	0.0	0.2
Dry (16%)	-0.8	-0.1	0.0	0.0	0.2	-0.3	-0.6	0.0	0.8	0.3	0.0	0.0
Critical (27%)	-1.2	-0.2	0.0	0.0	0.1	-1.0	-0.7	-0.4	0.6	1.2	0.3	-0.5

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.8.4 Stanislaus River at Orange Blossom Bridge, Monthly Temperature

Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	62.9	57.4	53.0	51.1	52.6	56.7	56.1	58.0	63.1	65.2	64.6	63.3
20%	61.5	56.4	52.6	50.6	51.7	55.8	55.4	57.4	62.6	64.3	63.6	62.4
30%	61.0	55.5	52.0	50.0	51.2	55.2	54.9	56.5	62.1	63.8	63.0	61.9
40%	59.5	55.0	51.5	49.6	50.8	54.4	54.2	56.0	61.5	63.5	62.7	61.4
50%	59.0	54.6	51.1	49.1	50.5	53.7	53.5	55.5	59.2	63.1	62.4	60.9
60%	57.9	54.3	50.8	49.0	50.0	53.3	53.2	54.8	56.4	62.6	62.1	60.6
70%	56.8	54.0	50.6	48.4	49.8	52.5	52.6	54.3	55.8	62.1	61.8	60.0
80%	56.4	53.5	50.3	48.0	49.3	51.6	51.9	53.8	55.1	61.5	61.5	59.5
90%	55.7	52.8	49.9	47.5	48.4	50.3	51.2	52.9	53.9	58.6	60.4	57.9
Long Term												
Full Simulation Period ^b	59.2	55.1	51.4	49.3	50.5	53.8	53.8	55.5	58.9	62.4	62.3	60.9
Water Year Types^c												
Wet (23%)	54.9	51.5	48.5	48.7	49.1	51.1	51.6	53.4	54.8	59.2	59.1	57.3
Above Normal (24%)	59.8	55.3	51.4	49.3	50.3	53.2	52.9	54.9	56.1	61.7	62.0	60.7
Below Normal (10%)	58.0	54.2	50.6	48.9	50.1	53.1	53.2	54.7	59.4	63.3	62.2	60.7
Dry (16%)	58.4	54.6	51.0	49.4	50.7	54.9	54.7	55.9	61.7	64.0	63.0	61.6
Critical (27%)	60.6	56.0	52.1	49.8	51.9	56.4	56.0	57.8	63.0	64.7	64.8	64.0

Alternative 5

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	65.0	59.6	53.4	51.3	52.5	55.7	54.6	56.3	64.0	66.4	67.0	67.3
20%	60.0	58.0	52.6	50.6	51.7	55.0	54.1	55.8	62.7	65.1	65.0	64.2
30%	58.1	56.5	52.2	49.9	51.2	54.5	53.7	55.4	61.8	64.3	63.7	62.7
40%	57.1	55.3	51.6	49.6	50.7	54.0	53.5	55.0	61.0	63.7	63.0	61.8
50%	56.5	55.0	51.2	49.1	50.3	53.6	53.0	54.7	59.2	63.2	62.7	61.3
60%	55.9	54.6	50.8	48.9	50.1	53.3	52.6	54.3	57.0	62.7	62.3	60.9
70%	55.4	54.2	50.6	48.4	49.6	52.0	52.2	53.7	55.9	62.2	61.9	60.6
80%	55.0	53.7	50.3	47.9	49.2	51.0	51.8	53.4	55.3	61.6	61.5	60.0
90%	54.0	53.1	49.8	47.2	48.3	49.6	50.7	52.6	54.4	58.9	60.1	58.1
Long Term												
Full Simulation Period ^b	57.8	55.7	51.5	49.2	50.4	53.1	52.9	54.8	59.1	63.3	63.2	61.9
Water Year Types^c												
Wet (23%)	53.6	52.0	48.7	48.7	49.3	50.3	51.3	53.1	55.3	60.2	60.0	58.0
Above Normal (24%)	58.6	56.0	51.2	48.9	49.8	52.6	52.4	54.0	56.3	62.0	62.4	61.4
Below Normal (10%)	57.0	54.6	50.6	48.8	50.2	53.3	52.9	54.3	59.1	63.5	62.6	61.5
Dry (16%)	56.8	55.4	51.4	49.6	51.0	54.5	53.5	54.9	61.5	64.6	63.9	62.7
Critical (27%)	59.0	56.6	52.2	49.8	51.6	55.1	54.5	57.0	63.7	66.2	66.5	65.6

Alternative 5 minus Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2.1	2.2	0.4	0.3	-0.1	-1.0	-1.5	-1.6	1.0	1.2	2.4	3.9
20%	-1.5	1.6	0.0	-0.1	0.0	-0.8	-1.3	-1.6	0.1	0.9	1.4	1.7
30%	-2.9	0.9	0.2	-0.1	0.0	-0.7	-1.3	-1.1	-0.4	0.5	0.7	0.9
40%	-2.4	0.2	0.1	-0.1	-0.1	-0.5	-0.7	-1.0	-0.5	0.2	0.3	0.4
50%	-2.5	0.4	0.0	-0.1	-0.2	-0.1	-0.4	-0.8	0.0	0.1	0.3	0.4
60%	-2.0	0.4	0.0	-0.1	0.0	0.0	-0.5	-0.5	0.7	0.2	0.2	0.3
70%	-1.4	0.2	0.0	0.0	-0.1	-0.5	-0.3	-0.6	0.1	0.1	0.1	0.5
80%	-1.4	0.2	0.0	-0.1	-0.1	-0.6	-0.1	-0.4	0.3	0.2	0.0	0.4
90%	-1.7	0.2	-0.1	-0.3	-0.2	-0.7	-0.5	-0.3	0.5	0.3	-0.3	0.1
Long Term												
Full Simulation Period ^b	-1.4	0.6	0.1	0.0	-0.1	-0.7	-0.8	-0.7	0.3	0.8	0.9	1.0
Water Year Types^c												
Wet (23%)	-1.3	0.5	0.2	0.1	0.2	-0.8	-0.3	-0.4	0.5	1.0	0.9	0.7
Above Normal (24%)	-1.2	0.6	-0.2	-0.3	-0.5	-0.5	-0.4	-0.9	0.1	0.3	0.4	0.7
Below Normal (10%)	-1.0	0.4	0.0	-0.1	0.1	0.2	-0.3	-0.4	-0.3	0.2	0.4	0.8
Dry (16%)	-1.6	0.8	0.4	0.2	0.2	-0.4	-1.3	-1.0	-0.2	0.6	0.9	1.0
Critical (27%)	-1.7	0.6	0.1	0.0	-0.2	-1.3	-1.5	-0.7	0.7	1.5	1.7	1.7

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

5C.3.2.9 Stanislaus River at Mouth Temperature

Table 5C.3.2.9.1 Stanislaus River at Mouth, Monthly Temperature

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	64.3	58.6	51.9	51.4	55.1	60.5	62.1	65.5	72.3	76.5	75.2	71.8
20%	62.9	57.4	51.6	50.8	54.3	59.7	61.1	64.6	71.7	75.5	74.4	70.7
30%	61.7	56.8	51.0	50.2	53.8	59.1	60.3	63.6	70.8	74.9	73.8	70.4
40%	60.6	56.5	50.7	49.7	53.2	58.7	58.8	62.1	70.2	74.3	73.4	69.8
50%	60.1	55.7	50.3	49.4	52.9	57.9	57.9	61.0	67.8	73.8	73.0	69.5
60%	59.6	55.2	49.9	49.0	52.6	57.0	57.1	60.7	65.3	73.1	72.6	69.0
70%	59.0	55.0	49.7	48.8	52.1	55.7	56.2	59.8	63.8	72.9	72.4	68.6
80%	58.7	54.7	49.3	48.5	51.5	53.6	55.7	58.7	62.7	71.7	71.9	68.1
90%	58.2	54.2	49.0	47.9	50.6	52.1	54.8	58.0	61.7	69.3	70.7	66.9
Long Term												
Full Simulation Period ^b	60.8	56.0	50.4	49.6	52.9	57.1	58.3	61.6	67.3	73.1	72.6	69.0
Water Year Types^c												
Wet (23%)	56.7	52.7	48.1	49.6	51.8	53.0	55.4	58.9	63.1	69.7	69.6	65.7
Above Normal (24%)	61.1	56.0	50.4	49.5	52.5	56.8	57.2	61.2	64.2	72.1	72.6	69.2
Below Normal (10%)	59.7	55.5	49.9	49.3	52.5	57.3	57.4	59.9	67.6	73.9	72.6	69.0
Dry (16%)	60.3	56.0	49.9	49.7	53.3	58.6	59.6	62.1	70.3	75.0	73.4	70.0
Critical (27%)	61.9	56.6	50.6	49.6	54.2	59.9	61.3	64.8	72.0	75.7	74.6	71.1

Revised Alternative 1

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	66.8	58.5	52.0	51.4	54.8	60.8	63.5	66.4	72.5	76.0	74.9	71.4
20%	65.8	57.8	51.4	50.7	54.1	60.1	62.8	65.6	72.2	75.4	74.2	70.4
30%	64.7	57.0	51.0	50.2	53.8	59.3	61.6	64.6	71.1	74.8	73.6	70.1
40%	64.1	56.5	50.7	49.7	53.2	58.9	60.2	63.7	70.6	74.3	73.3	69.7
50%	63.5	55.8	50.2	49.2	52.6	57.5	59.5	62.6	68.3	73.9	72.9	69.4
60%	62.5	55.5	50.0	49.0	52.3	57.1	57.8	61.7	65.2	73.2	72.5	68.8
70%	61.9	55.2	49.6	48.8	51.9	56.5	56.8	60.0	63.8	72.7	72.3	68.5
80%	61.2	54.8	49.4	48.5	51.0	55.8	56.1	59.1	62.4	71.8	72.0	68.0
90%	60.2	54.3	48.9	47.9	50.3	53.9	55.4	58.6	61.3	69.0	71.0	66.9
Long Term												
Full Simulation Period ^b	63.4	56.2	50.4	49.5	52.7	57.6	59.3	62.5	67.2	72.9	72.3	68.6
Water Year Types^c												
Wet (23%)	59.2	52.8	48.0	49.6	51.0	54.5	55.8	59.3	61.8	68.8	68.9	64.7
Above Normal (24%)	63.5	56.1	50.4	49.6	52.5	57.2	58.0	61.9	64.1	72.0	72.6	69.0
Below Normal (10%)	62.4	55.5	49.9	49.2	52.1	57.1	58.3	60.9	68.2	74.0	72.6	68.9
Dry (16%)	63.1	56.1	49.9	49.6	53.1	58.6	61.3	63.3	70.8	75.1	73.2	69.7
Critical (27%)	64.6	56.9	50.6	49.5	54.2	60.3	62.8	65.9	72.1	75.4	74.3	70.8

Revised Alternative 1 minus No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2.5	-0.1	0.1	0.0	-0.2	0.3	1.4	0.9	0.2	-0.5	-0.4	-0.5
20%	2.8	0.4	-0.1	0.0	-0.2	0.5	1.7	1.0	0.5	0.0	-0.2	-0.3
30%	3.0	0.1	-0.1	0.0	0.0	0.2	1.4	1.1	0.4	-0.1	-0.2	-0.3
40%	3.5	0.0	0.0	0.0	0.0	0.2	1.5	1.5	0.4	0.1	-0.2	-0.2
50%	3.4	0.2	0.0	-0.2	-0.4	-0.4	1.6	1.7	0.5	0.0	-0.1	-0.1
60%	2.9	0.2	0.1	0.0	-0.3	0.2	0.7	1.0	-0.1	0.1	0.0	-0.2
70%	2.8	0.2	0.0	-0.1	-0.3	0.9	0.5	0.2	0.0	-0.1	0.0	-0.1
80%	2.5	0.1	0.1	0.0	-0.5	2.2	0.4	0.4	-0.3	0.1	0.1	-0.1
90%	2.0	0.1	-0.2	0.1	-0.3	1.8	0.6	0.6	-0.4	-0.4	0.3	0.0
Long Term												
Full Simulation Period ^b	2.6	0.1	0.0	0.0	-0.2	0.5	1.0	0.9	-0.2	-0.3	-0.3	-0.4
Water Year Types^c												
Wet (23%)	2.5	0.1	0.0	-0.1	-0.7	1.5	0.4	0.5	-1.3	-0.9	-0.7	-1.0
Above Normal (24%)	2.4	0.1	0.0	0.1	0.0	0.4	0.8	0.6	-0.1	-0.1	0.0	-0.1
Below Normal (10%)	2.6	-0.1	0.0	-0.1	-0.4	-0.2	0.9	1.0	0.6	0.1	0.0	-0.2
Dry (16%)	2.8	0.1	0.0	-0.1	-0.2	0.0	1.7	1.2	0.5	0.0	-0.2	-0.2
Critical (27%)	2.7	0.2	0.0	0.0	0.0	0.4	1.5	1.2	0.2	-0.3	-0.3	-0.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.9.2 Stanislaus River at Mouth, Monthly Temperature

Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	66.8	58.5	52.0	51.4	54.8	60.8	63.5	66.4	72.5	76.0	74.9	71.4
20%	65.8	57.8	51.4	50.7	54.1	60.1	62.8	65.6	72.2	75.4	74.2	70.4
30%	64.7	57.0	51.0	50.2	53.8	59.3	61.6	64.6	71.1	74.8	73.6	70.1
40%	64.1	56.5	50.7	49.7	53.2	58.9	60.2	63.7	70.6	74.3	73.3	69.7
50%	63.5	55.8	50.2	49.2	52.6	57.5	59.5	62.6	68.3	73.9	72.9	69.4
60%	62.5	55.5	50.0	49.0	52.3	57.1	57.8	61.7	65.2	73.2	72.5	68.8
70%	61.9	55.2	49.6	48.8	51.9	56.5	56.8	60.0	63.8	72.7	72.3	68.5
80%	61.2	54.8	49.4	48.5	51.0	55.8	56.1	59.1	62.4	71.8	72.0	68.0
90%	60.2	54.3	48.9	47.9	50.3	53.9	55.4	58.6	61.3	69.0	71.0	66.9
Long Term												
Full Simulation Period ^b	63.4	56.2	50.4	49.5	52.7	57.6	59.3	62.5	67.2	72.9	72.3	68.6
Water Year Types^c												
Wet (23%)	59.2	52.8	48.0	49.6	51.0	54.5	55.8	59.3	61.8	68.8	68.9	64.7
Above Normal (24%)	63.5	56.1	50.4	49.6	52.5	57.2	58.0	61.9	64.1	72.0	72.6	69.0
Below Normal (10%)	62.4	55.5	49.9	49.2	52.1	57.1	58.3	60.9	68.2	74.0	72.6	68.9
Dry (16%)	63.1	56.1	49.9	49.6	53.1	58.6	61.3	63.3	70.8	75.1	73.2	69.7
Critical (27%)	64.6	56.9	50.6	49.5	54.2	60.3	62.8	65.9	72.1	75.4	74.3	70.8

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	64.3	58.6	51.9	51.4	55.1	60.5	62.1	65.5	72.3	76.5	75.2	71.8
20%	62.9	57.4	51.6	50.8	54.3	59.7	61.1	64.6	71.7	75.5	74.4	70.7
30%	61.7	56.8	51.0	50.2	53.8	59.1	60.3	63.6	70.8	74.9	73.8	70.4
40%	60.6	56.5	50.7	49.7	53.2	58.7	58.8	62.1	70.2	74.3	73.4	69.8
50%	60.1	55.7	50.3	49.4	52.9	57.9	57.9	61.0	67.8	73.8	73.0	69.5
60%	59.6	55.2	49.9	49.0	52.6	57.0	57.1	60.7	65.3	73.1	72.6	69.0
70%	59.0	55.0	49.7	48.8	52.1	55.7	56.2	59.8	63.8	72.9	72.4	68.6
80%	58.7	54.7	49.3	48.5	51.5	53.6	55.7	58.7	62.7	71.7	71.9	68.1
90%	58.2	54.2	49.0	47.9	50.6	52.1	54.8	58.0	61.7	69.3	70.7	66.9
Long Term												
Full Simulation Period ^b	60.8	56.0	50.4	49.6	52.9	57.1	58.3	61.6	67.3	73.1	72.6	69.0
Water Year Types^c												
Wet (23%)	56.7	52.7	48.1	49.6	51.8	53.0	55.4	58.9	63.1	69.7	69.6	65.7
Above Normal (24%)	61.1	56.0	50.4	49.5	52.5	56.8	57.2	61.2	64.2	72.1	72.6	69.2
Below Normal (10%)	59.7	55.5	49.9	49.3	52.5	57.3	57.4	59.9	67.6	73.9	72.6	69.0
Dry (16%)	60.3	56.0	49.9	49.7	53.3	58.6	59.6	62.1	70.3	75.0	73.4	70.0
Critical (27%)	61.9	56.6	50.6	49.6	54.2	59.9	61.3	64.8	72.0	75.7	74.6	71.1

No Action Alternative minus Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-2.5	0.1	-0.1	0.0	0.2	-0.3	-1.4	-0.9	-0.2	0.5	0.4	0.5
20%	-2.8	-0.4	0.1	0.0	0.2	-0.5	-1.7	-1.0	-0.5	0.0	0.2	0.3
30%	-3.0	-0.1	0.1	0.0	0.0	-0.2	-1.4	-1.1	-0.4	0.1	0.2	0.3
40%	-3.5	0.0	0.0	0.0	0.0	-0.2	-1.5	-1.5	-0.4	-0.1	0.2	0.2
50%	-3.4	-0.2	0.0	0.2	0.4	0.4	-1.6	-1.7	-0.5	0.0	0.1	0.1
60%	-2.9	-0.2	-0.1	0.0	0.3	-0.2	-0.7	-1.0	0.1	-0.1	0.0	0.2
70%	-2.8	-0.2	0.0	0.1	0.3	-0.9	-0.5	-0.2	0.0	0.1	0.0	0.1
80%	-2.5	-0.1	-0.1	0.0	0.5	-2.2	-0.4	-0.4	0.3	-0.1	-0.1	0.1
90%	-2.0	-0.1	0.2	-0.1	0.3	-1.8	-0.6	-0.6	0.4	0.4	-0.3	0.0
Long Term												
Full Simulation Period ^b	-2.6	-0.1	0.0	0.0	0.2	-0.5	-1.0	-0.9	0.2	0.3	0.3	0.4
Water Year Types^c												
Wet (23%)	-2.5	-0.1	0.0	0.1	0.7	-1.5	-0.4	-0.5	1.3	0.9	0.7	1.0
Above Normal (24%)	-2.4	-0.1	0.0	-0.1	0.0	-0.4	-0.8	-0.6	0.1	0.1	0.0	0.1
Below Normal (10%)	-2.6	0.1	0.0	0.1	0.4	0.2	-0.9	-1.0	-0.6	-0.1	0.0	0.2
Dry (16%)	-2.8	-0.1	0.0	0.1	0.2	0.0	-1.7	-1.2	-0.5	0.0	0.2	0.2
Critical (27%)	-2.7	-0.2	0.0	0.0	0.0	-0.4	-1.5	-1.2	-0.2	0.3	0.3	0.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.9.3 Stanislaus River at Mouth, Monthly Temperature

Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	66.8	58.5	52.0	51.4	54.8	60.8	63.5	66.4	72.5	76.0	74.9	71.4
20%	65.8	57.8	51.4	50.7	54.1	60.1	62.8	65.6	72.2	75.4	74.2	70.4
30%	64.7	57.0	51.0	50.2	53.8	59.3	61.6	64.6	71.1	74.8	73.6	70.1
40%	64.1	56.5	50.7	49.7	53.2	58.9	60.2	63.7	70.6	74.3	73.3	69.7
50%	63.5	55.8	50.2	49.2	52.6	57.5	59.5	62.6	68.3	73.9	72.9	69.4
60%	62.5	55.5	50.0	49.0	52.3	57.1	57.8	61.7	65.2	73.2	72.5	68.8
70%	61.9	55.2	49.6	48.8	51.9	56.5	56.8	60.0	63.8	72.7	72.3	68.5
80%	61.2	54.8	49.4	48.5	51.0	55.8	56.1	59.1	62.4	71.8	72.0	68.0
90%	60.2	54.3	48.9	47.9	50.3	53.9	55.4	58.6	61.3	69.0	71.0	66.9
Long Term												
Full Simulation Period ^b	63.4	56.2	50.4	49.5	52.7	57.6	59.3	62.5	67.2	72.9	72.3	68.6
Water Year Types^c												
Wet (23%)	59.2	52.8	48.0	49.6	51.0	54.5	55.8	59.3	61.8	68.8	68.9	64.7
Above Normal (24%)	63.5	56.1	50.4	49.6	52.5	57.2	58.0	61.9	64.1	72.0	72.6	69.0
Below Normal (10%)	62.4	55.5	49.9	49.2	52.1	57.1	58.3	60.9	68.2	74.0	72.6	68.9
Dry (16%)	63.1	56.1	49.9	49.6	53.1	58.6	61.3	63.3	70.8	75.1	73.2	69.7
Critical (27%)	64.6	56.9	50.6	49.5	54.2	60.3	62.8	65.9	72.1	75.4	74.3	70.8

Alternative 3

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	65.7	58.3	51.9	51.6	55.2	60.9	62.6	65.8	73.2	76.9	75.3	71.7
20%	65.2	57.7	51.5	50.7	54.7	59.7	61.6	64.6	72.4	76.0	74.3	70.7
30%	64.0	56.7	51.0	50.2	53.8	59.2	60.4	63.7	72.1	75.5	73.8	70.2
40%	63.2	56.3	50.8	49.7	53.2	58.7	59.7	62.9	71.7	75.0	73.4	69.9
50%	62.9	55.6	50.4	49.4	52.8	58.2	58.3	62.5	71.1	74.7	73.1	69.4
60%	62.4	55.3	50.0	49.0	52.3	57.3	57.3	61.7	70.3	74.2	72.5	69.0
70%	61.7	55.0	49.6	48.8	52.0	56.7	56.6	60.9	69.3	73.8	72.4	68.7
80%	61.3	54.8	49.4	48.6	51.1	55.0	56.1	60.2	68.5	73.5	72.0	68.1
90%	60.6	54.3	49.0	47.9	50.3	53.5	55.4	59.0	67.4	73.0	71.3	62.2
Long Term												
Full Simulation Period ^b	62.9	56.0	50.4	49.6	52.8	57.5	58.7	62.5	69.9	73.7	72.4	68.6
Water Year Types^c												
Wet (23%)	58.8	52.7	48.1	49.7	51.1	54.6	55.7	60.0	65.7	69.2	68.6	64.6
Above Normal (24%)	62.9	56.0	50.5	49.7	52.6	57.1	57.4	61.8	70.2	74.2	72.9	69.2
Below Normal (10%)	62.3	55.5	49.9	49.1	52.1	57.3	58.2	61.2	70.0	74.4	72.6	69.0
Dry (16%)	62.6	55.9	49.9	49.6	53.3	58.6	60.4	63.3	71.6	75.4	73.2	69.7
Critical (27%)	64.0	56.6	50.7	49.5	54.4	60.0	61.6	65.1	72.3	76.0	74.5	70.8

Alternative 3 minus Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-1.1	-0.2	0.0	0.2	0.4	0.0	-0.9	-0.6	0.6	1.0	0.4	0.4
20%	-0.6	-0.1	0.1	0.0	0.6	-0.4	-1.3	-1.0	0.2	0.6	0.1	0.2
30%	-0.7	-0.2	0.0	0.0	0.0	-0.1	-1.2	-0.9	1.0	0.7	0.2	0.1
40%	-0.9	-0.2	0.1	0.0	0.0	-0.2	-0.5	-0.7	1.1	0.7	0.1	0.2
50%	-0.7	-0.2	0.2	0.2	0.3	0.7	-1.2	-0.2	2.7	0.8	0.1	0.0
60%	-0.1	-0.1	0.0	-0.1	0.1	0.2	-0.5	0.0	5.1	1.0	0.0	0.2
70%	-0.1	-0.2	0.0	0.1	0.1	0.2	-0.1	0.9	5.5	1.1	0.1	0.1
80%	0.1	0.0	0.0	0.1	0.0	-0.8	0.0	1.1	6.1	1.8	0.0	0.0
90%	0.4	0.0	0.1	0.0	0.0	-0.3	0.0	0.4	6.1	4.0	0.4	-4.7
Long Term												
Full Simulation Period ^b	-0.5	-0.1	0.1	0.0	0.1	-0.1	-0.6	-0.1	2.7	0.9	0.1	0.0
Water Year Types^c												
Wet (23%)	-0.3	-0.1	0.0	0.1	0.1	0.1	-0.1	0.6	3.9	0.4	-0.3	-0.1
Above Normal (24%)	-0.6	-0.1	0.1	0.0	0.0	-0.1	-0.5	0.0	6.1	2.2	0.3	0.1
Below Normal (10%)	-0.1	0.0	0.0	-0.1	0.1	0.2	-0.2	0.3	1.8	0.4	0.0	0.2
Dry (16%)	-0.5	-0.1	0.0	0.0	0.2	0.0	-1.0	0.0	0.8	0.3	0.0	0.0
Critical (27%)	-0.6	-0.2	0.1	0.0	0.2	-0.2	-1.2	-0.8	0.2	0.6	0.3	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.9.4 Stanislaus River at Mouth, Monthly Temperature

Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	66.8	58.5	52.0	51.4	54.8	60.8	63.5	66.4	72.5	76.0	74.9	71.4
20%	65.8	57.8	51.4	50.7	54.1	60.1	62.8	65.6	72.2	75.4	74.2	70.4
30%	64.7	57.0	51.0	50.2	53.8	59.3	61.6	64.6	71.1	74.8	73.6	70.1
40%	64.1	56.5	50.7	49.7	53.2	58.9	60.2	63.7	70.6	74.3	73.3	69.7
50%	63.5	55.8	50.2	49.2	52.6	57.5	59.5	62.6	68.3	73.9	72.9	69.4
60%	62.5	55.5	50.0	49.0	52.3	57.1	57.8	61.7	65.2	73.2	72.5	68.8
70%	61.9	55.2	49.6	48.8	51.9	56.5	56.8	60.0	63.8	72.7	72.3	68.5
80%	61.2	54.8	49.4	48.5	51.0	55.8	56.1	59.1	62.4	71.8	72.0	68.0
90%	60.2	54.3	48.9	47.9	50.3	53.9	55.4	58.6	61.3	69.0	71.0	66.9
Long Term												
Full Simulation Period ^b	63.4	56.2	50.4	49.5	52.7	57.6	59.3	62.5	67.2	72.9	72.3	68.6
Water Year Types^c												
Wet (23%)	59.2	52.8	48.0	49.6	51.0	54.5	55.8	59.3	61.8	68.8	68.9	64.7
Above Normal (24%)	63.5	56.1	50.4	49.6	52.5	57.2	58.0	61.9	64.1	72.0	72.6	69.0
Below Normal (10%)	62.4	55.5	49.9	49.2	52.1	57.1	58.3	60.9	68.2	74.0	72.6	68.9
Dry (16%)	63.1	56.1	49.9	49.6	53.1	58.6	61.3	63.3	70.8	75.1	73.2	69.7
Critical (27%)	64.6	56.9	50.6	49.5	54.2	60.3	62.8	65.9	72.1	75.4	74.3	70.8

Alternative 5

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	65.4	58.6	52.2	51.4	55.1	60.5	60.1	64.4	72.3	76.3	75.4	72.0
20%	63.3	57.7	51.5	50.8	54.4	59.7	59.1	62.6	71.8	75.6	74.6	71.0
30%	62.0	57.0	51.0	50.3	53.7	59.2	58.7	61.5	70.9	75.0	73.9	70.5
40%	61.1	56.7	50.5	49.7	53.2	58.7	58.3	60.8	70.1	74.3	73.5	70.0
50%	60.4	56.0	50.3	49.3	52.9	57.9	57.7	60.1	67.6	73.9	73.1	69.7
60%	59.7	55.4	50.0	49.0	52.6	57.1	57.3	59.5	65.2	73.1	72.6	69.2
70%	59.2	55.1	49.7	48.9	52.0	55.9	56.3	59.0	64.0	72.9	72.4	68.7
80%	58.7	54.8	49.3	48.5	51.5	53.8	55.7	58.3	62.7	72.0	72.0	68.2
90%	58.2	54.2	48.9	47.9	50.6	52.1	55.0	57.9	61.5	69.4	71.3	66.9
Long Term												
Full Simulation Period ^b	61.1	56.2	50.4	49.6	52.9	57.1	57.6	60.6	67.4	73.4	72.9	69.2
Water Year Types^c												
Wet (23%)	57.0	52.8	48.1	49.7	51.8	53.3	55.4	58.8	63.4	70.6	70.6	66.0
Above Normal (24%)	61.5	56.3	50.4	49.5	52.5	56.8	57.4	59.9	64.1	72.1	72.7	69.3
Below Normal (10%)	60.2	55.5	49.9	49.3	52.5	57.2	57.5	59.9	67.8	73.9	72.6	69.1
Dry (16%)	60.6	56.2	50.0	49.7	53.4	58.6	58.2	60.3	70.2	75.1	73.5	70.0
Critical (27%)	62.1	56.8	50.7	49.6	54.2	59.9	59.4	63.4	72.0	75.9	74.8	71.5

Alternative 5 minus Revised Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-1.3	0.2	0.2	0.0	0.3	-0.3	-3.4	-2.0	-0.2	0.4	0.5	0.7
20%	-2.4	-0.1	0.1	0.0	0.3	-0.5	-3.7	-3.1	-0.4	0.2	0.4	0.6
30%	-2.7	0.0	0.1	0.1	-0.1	-0.1	-2.9	-3.1	-0.2	0.2	0.4	0.3
40%	-3.1	0.2	-0.2	0.0	0.1	-0.2	-1.9	-2.9	-0.4	0.0	0.2	0.3
50%	-3.1	0.1	0.1	0.0	0.4	0.4	-1.8	-2.5	-0.7	0.0	0.2	0.3
60%	-2.8	-0.1	0.0	0.0	0.3	0.0	-0.5	-2.2	-0.1	-0.1	0.1	0.4
70%	-2.7	-0.2	0.0	0.1	0.1	-0.6	-0.5	-1.0	0.2	0.2	0.1	0.2
80%	-2.5	0.0	0.0	0.0	0.5	-2.0	-0.4	-0.7	0.3	0.3	0.0	0.2
90%	-2.0	0.0	0.0	0.0	0.3	-1.8	-0.4	-0.7	0.2	0.5	0.3	0.0
Long Term												
Full Simulation Period ^b	-2.3	0.0	0.1	0.0	0.3	-0.5	-1.7	-1.9	0.2	0.6	0.6	0.6
Water Year Types^c												
Wet (23%)	-2.2	0.0	0.1	0.1	0.7	-1.2	-0.4	-0.6	1.6	1.8	1.7	1.3
Above Normal (24%)	-1.9	0.1	0.0	-0.1	0.0	-0.5	-0.6	-1.9	0.0	0.1	0.1	0.2
Below Normal (10%)	-2.1	0.0	0.0	0.1	0.4	0.1	-0.8	-1.0	-0.4	0.0	0.1	0.3
Dry (16%)	-2.5	0.1	0.1	0.1	0.3	0.0	-3.1	-3.0	-0.6	0.1	0.3	0.3
Critical (27%)	-2.4	0.0	0.1	0.1	0.1	-0.4	-3.3	-2.6	-0.1	0.5	0.6	0.6

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

5C.3.2.10 San Joaquin River at Vernalis Flow

Table 5C.3.2.10.1 San Joaquin River at Vernalis, Monthly Flow

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,498	2,953	4,804	11,135	14,596	15,471	14,974	14,174	9,351	5,890	2,796	3,060
20%	3,161	2,777	2,857	4,812	10,143	10,197	10,637	8,318	4,690	2,628	2,589	2,654
30%	2,980	2,527	2,401	3,610	6,118	8,459	8,616	5,534	3,364	1,985	1,904	2,490
40%	2,796	2,395	2,215	2,629	4,232	5,570	7,564	4,609	2,947	1,735	1,666	2,125
50%	2,601	2,219	2,101	2,402	3,420	3,847	6,017	3,925	2,246	1,487	1,488	1,930
60%	2,401	2,169	2,046	2,293	2,683	3,459	4,832	3,062	1,859	1,366	1,403	1,835
70%	2,247	2,059	1,979	2,114	2,305	2,906	3,776	2,699	1,448	1,154	1,307	1,739
80%	1,994	1,951	1,829	1,884	2,150	2,371	2,789	2,153	1,293	1,087	1,202	1,611
90%	1,849	1,763	1,669	1,699	1,947	2,204	1,887	1,678	1,085	885	1,067	1,476
Long Term												
Full Simulation Period ^b	2,672	2,611	3,391	5,070	6,655	7,278	7,528	6,039	4,194	2,622	1,847	2,223
Water Year Types^c												
Wet (23%)	2,918	3,513	6,545	11,446	15,776	16,863	15,423	14,628	11,335	6,676	3,135	3,416
Above Normal (24%)	2,700	2,416	2,663	4,883	6,881	7,536	8,542	5,264	3,280	1,989	1,975	2,345
Below Normal (10%)	2,538	2,249	3,661	3,507	3,651	4,149	6,337	4,140	2,076	1,463	1,446	1,837
Dry (16%)	2,767	2,569	2,232	2,402	2,549	3,241	3,996	2,805	1,680	1,254	1,347	1,776
Critical (27%)	2,426	2,168	1,915	1,877	2,090	2,288	2,307	1,929	1,115	926	1,060	1,487

Revised Alternative 1

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,058	3,088	4,931	11,054	17,256	15,467	14,774	14,101	9,720	6,052	2,996	3,315
20%	2,699	2,813	2,924	4,859	10,259	9,401	10,359	8,202	4,768	2,636	2,599	2,659
30%	2,470	2,631	2,462	3,635	6,228	7,841	8,536	5,452	3,364	1,988	1,896	2,484
40%	2,326	2,448	2,299	2,606	4,252	5,343	7,507	4,488	2,947	1,742	1,675	2,152
50%	2,089	2,342	2,226	2,481	3,420	3,825	6,018	3,916	2,205	1,503	1,499	1,934
60%	1,895	2,218	2,100	2,247	2,681	3,460	4,432	2,913	1,824	1,384	1,415	1,837
70%	1,697	2,100	1,988	2,070	2,379	2,870	3,224	2,493	1,420	1,170	1,322	1,743
80%	1,511	1,954	1,866	1,827	2,153	2,327	2,452	1,994	1,271	1,087	1,211	1,611
90%	1,338	1,753	1,671	1,638	1,931	2,115	1,813	1,564	1,085	941	1,099	1,503
Long Term												
Full Simulation Period ^b	2,200	2,673	3,455	5,082	6,806	7,116	7,330	5,903	4,350	2,668	1,876	2,266
Water Year Types^c												
Wet (23%)	2,472	3,596	6,642	11,484	16,260	16,444	15,398	14,493	12,009	6,823	3,227	3,582
Above Normal (24%)	2,234	2,469	2,712	4,887	6,916	7,376	8,371	5,184	3,310	1,997	1,976	2,348
Below Normal (10%)	2,052	2,330	3,742	3,561	3,837	4,077	5,974	3,968	2,025	1,478	1,455	1,847
Dry (16%)	2,305	2,644	2,306	2,421	2,623	3,227	3,656	2,625	1,661	1,266	1,362	1,783
Critical (27%)	1,926	2,205	1,952	1,854	2,092	2,228	2,079	1,780	1,114	951	1,077	1,490

Revised Alternative 1 minus No Action Alternative

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-13%	5%	3%	-1%	18%	0%	-1%	-1%	4%	3%	7%	8%
20%	-15%	1%	2%	1%	1%	-8%	-3%	-1%	2%	0%	0%	0%
30%	-17%	4%	3%	1%	2%	-7%	-1%	-1%	0%	0%	0%	0%
40%	-17%	2%	4%	-1%	0%	-4%	-1%	-3%	0%	0%	1%	1%
50%	-20%	6%	6%	3%	0%	-1%	0%	0%	-2%	1%	1%	0%
60%	-21%	2%	3%	-2%	0%	0%	-8%	-5%	-2%	1%	1%	0%
70%	-24%	2%	0%	-2%	3%	-1%	-15%	-8%	-2%	1%	1%	0%
80%	-24%	0%	2%	-3%	0%	-2%	-12%	-7%	-2%	0%	1%	0%
90%	-28%	-1%	0%	-4%	-1%	-4%	-4%	-7%	0%	6%	3%	2%
Long Term												
Full Simulation Period ^b	-18%	2%	2%	0%	2%	-2%	-3%	-2%	4%	2%	2%	2%
Water Year Types^c												
Wet (23%)	-15%	2%	1%	0%	3%	-2%	0%	-1%	6%	2%	3%	5%
Above Normal (24%)	-17%	2%	2%	0%	1%	-2%	-2%	-2%	1%	0%	0%	0%
Below Normal (10%)	-19%	4%	2%	2%	5%	-2%	-6%	-4%	-2%	1%	1%	1%
Dry (16%)	-17%	3%	3%	1%	3%	0%	-9%	-6%	-1%	1%	1%	0%
Critical (27%)	-21%	2%	2%	-1%	0%	-3%	-10%	-8%	0%	3%	2%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.10.2 San Joaquin River at Vernalis, Monthly Flow

Revised Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,058	3,088	4,931	11,054	17,256	15,467	14,774	14,101	9,720	6,052	2,996	3,315
20%	2,699	2,813	2,924	4,859	10,259	9,401	10,359	8,202	4,768	2,636	2,599	2,659
30%	2,470	2,631	2,462	3,635	6,228	7,841	8,536	5,452	3,364	1,988	1,896	2,484
40%	2,326	2,448	2,299	2,606	4,252	5,343	7,507	4,488	2,947	1,742	1,675	2,152
50%	2,089	2,342	2,226	2,481	3,420	3,825	6,018	3,916	2,205	1,503	1,499	1,934
60%	1,895	2,218	2,100	2,247	2,681	3,460	4,432	2,913	1,824	1,384	1,415	1,837
70%	1,697	2,100	1,988	2,070	2,379	2,870	3,224	2,493	1,420	1,170	1,322	1,743
80%	1,511	1,954	1,866	1,827	2,153	2,327	2,452	1,994	1,271	1,087	1,211	1,611
90%	1,338	1,753	1,671	1,638	1,931	2,115	1,813	1,564	1,085	941	1,099	1,503
Long Term												
Full Simulation Period ^b	2,200	2,673	3,455	5,082	6,806	7,116	7,330	5,903	4,350	2,668	1,876	2,266
Water Year Types^c												
Wet (23%)	2,472	3,596	6,642	11,484	16,260	16,444	15,398	14,493	12,009	6,823	3,227	3,582
Above Normal (24%)	2,234	2,469	2,712	4,887	6,916	7,376	8,371	5,184	3,310	1,997	1,976	2,348
Below Normal (10%)	2,052	2,330	3,742	3,561	3,837	4,077	5,974	3,968	2,025	1,478	1,455	1,847
Dry (16%)	2,305	2,644	2,306	2,421	2,623	3,227	3,656	2,625	1,661	1,266	1,362	1,783
Critical (27%)	1,926	2,205	1,952	1,854	2,092	2,228	2,079	1,780	1,114	951	1,077	1,490

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,498	2,953	4,804	11,135	14,596	15,471	14,974	14,174	9,351	5,890	2,796	3,060
20%	3,161	2,777	2,857	4,812	10,143	10,197	10,637	8,318	4,690	2,628	2,589	2,654
30%	2,980	2,527	2,401	3,610	6,118	8,459	8,616	5,534	3,364	1,985	1,904	2,490
40%	2,796	2,395	2,215	2,629	4,232	5,570	7,564	4,609	2,947	1,735	1,666	2,125
50%	2,601	2,219	2,101	2,402	3,420	3,847	6,017	3,925	2,246	1,487	1,488	1,930
60%	2,401	2,169	2,046	2,293	2,683	3,459	4,832	3,062	1,859	1,366	1,403	1,835
70%	2,247	2,059	1,979	2,114	2,305	2,906	3,776	2,699	1,448	1,154	1,307	1,739
80%	1,994	1,951	1,829	1,884	2,150	2,371	2,789	2,153	1,293	1,087	1,202	1,611
90%	1,849	1,763	1,669	1,699	1,947	2,204	1,887	1,678	1,085	885	1,067	1,476
Long Term												
Full Simulation Period ^b	2,672	2,611	3,391	5,070	6,655	7,278	7,528	6,039	4,194	2,622	1,847	2,223
Water Year Types^c												
Wet (23%)	2,918	3,513	6,545	11,446	15,776	16,863	15,423	14,628	11,335	6,676	3,135	3,416
Above Normal (24%)	2,700	2,416	2,663	4,883	6,881	7,536	8,542	5,264	3,280	1,989	1,975	2,345
Below Normal (10%)	2,538	2,249	3,661	3,507	3,651	4,149	6,337	4,140	2,076	1,463	1,446	1,837
Dry (16%)	2,767	2,569	2,232	2,402	2,549	3,241	3,996	2,805	1,680	1,254	1,347	1,776
Critical (27%)	2,426	2,168	1,915	1,877	2,090	2,288	2,307	1,929	1,115	926	1,060	1,487

No Action Alternative minus Revised Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	14%	-4%	-3%	1%	-15%	0%	1%	1%	-4%	-3%	-7%	-8%
20%	17%	-1%	-2%	-1%	-1%	8%	3%	1%	-2%	0%	0%	0%
30%	21%	-4%	-3%	-1%	-2%	8%	1%	2%	0%	0%	0%	0%
40%	20%	-2%	-4%	1%	0%	4%	1%	3%	0%	0%	-1%	-1%
50%	25%	-5%	-6%	-3%	0%	1%	0%	0%	2%	-1%	-1%	0%
60%	27%	-2%	-3%	2%	0%	0%	9%	5%	2%	-1%	-1%	0%
70%	32%	-2%	0%	2%	-3%	1%	17%	8%	2%	-1%	-1%	0%
80%	32%	0%	-2%	3%	0%	2%	14%	8%	2%	0%	-1%	0%
90%	38%	1%	0%	4%	1%	4%	4%	7%	0%	-6%	-3%	-2%
Long Term												
Full Simulation Period ^b	21%	-2%	-2%	0%	-2%	2%	3%	2%	-4%	-2%	-2%	-2%
Water Year Types^c												
Wet (23%)	18%	-2%	-1%	0%	-3%	3%	0%	1%	-6%	-2%	-3%	-5%
Above Normal (24%)	21%	-2%	-2%	0%	-1%	2%	2%	2%	-1%	0%	0%	0%
Below Normal (10%)	24%	-3%	-2%	-2%	-5%	2%	6%	4%	2%	-1%	-1%	-1%
Dry (16%)	20%	-3%	-3%	-1%	-3%	0%	9%	7%	1%	-1%	-1%	0%
Critical (27%)	26%	-2%	-2%	1%	0%	3%	11%	8%	0%	-3%	-2%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.10.3 San Joaquin River at Vernalis, Monthly Flow

Revised Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,058	3,088	4,931	11,054	17,256	15,467	14,774	14,101	9,720	6,052	2,996	3,315
20%	2,699	2,813	2,924	4,859	10,259	9,401	10,359	8,202	4,768	2,636	2,599	2,659
30%	2,470	2,631	2,462	3,635	6,228	7,841	8,536	5,452	3,364	1,988	1,896	2,484
40%	2,326	2,448	2,299	2,606	4,252	5,343	7,507	4,488	2,947	1,742	1,675	2,152
50%	2,089	2,342	2,226	2,481	3,420	3,825	6,018	3,916	2,205	1,503	1,499	1,934
60%	1,895	2,218	2,100	2,247	2,681	3,460	4,432	2,913	1,824	1,384	1,415	1,837
70%	1,697	2,100	1,988	2,070	2,379	2,870	3,224	2,493	1,420	1,170	1,322	1,743
80%	1,511	1,954	1,866	1,827	2,153	2,327	2,452	1,994	1,271	1,087	1,211	1,611
90%	1,338	1,753	1,671	1,638	1,931	2,115	1,813	1,564	1,085	941	1,099	1,503
Long Term												
Full Simulation Period ^b	2,200	2,673	3,455	5,082	6,806	7,116	7,330	5,903	4,350	2,668	1,876	2,266
Water Year Types^c												
Wet (23%)	2,472	3,596	6,642	11,484	16,260	16,444	15,398	14,493	12,009	6,823	3,227	3,582
Above Normal (24%)	2,234	2,469	2,712	4,887	6,916	7,376	8,371	5,184	3,310	1,997	1,976	2,348
Below Normal (10%)	2,052	2,330	3,742	3,561	3,837	4,077	5,974	3,968	2,025	1,478	1,455	1,847
Dry (16%)	2,305	2,644	2,306	2,421	2,623	3,227	3,656	2,625	1,661	1,266	1,362	1,783
Critical (27%)	1,926	2,205	1,952	1,854	2,092	2,228	2,079	1,780	1,114	951	1,077	1,490

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,023	3,053	4,949	12,089	17,246	15,467	14,936	14,309	10,004	6,473	3,525	3,287
20%	2,667	2,830	2,938	4,833	10,213	9,874	10,251	7,931	4,627	2,495	2,587	2,623
30%	2,494	2,583	2,421	3,540	6,797	7,753	8,532	5,438	2,558	1,926	1,892	2,464
40%	2,328	2,478	2,304	2,753	4,210	5,305	7,580	4,344	2,294	1,722	1,667	2,125
50%	2,137	2,313	2,191	2,439	3,215	3,847	6,112	3,821	1,955	1,506	1,495	1,932
60%	1,956	2,244	2,140	2,236	2,668	3,440	4,501	2,907	1,700	1,361	1,415	1,838
70%	1,782	2,148	2,012	2,088	2,360	2,906	3,355	2,502	1,364	1,164	1,319	1,743
80%	1,609	1,974	1,886	1,824	2,090	2,371	2,581	2,158	1,241	1,026	1,211	1,612
90%	1,466	1,763	1,669	1,639	1,849	2,205	1,936	1,650	1,001	930	1,065	1,477
Long Term												
Full Simulation Period ^b	2,252	2,683	3,501	5,108	6,872	7,145	7,431	5,830	4,009	2,655	1,882	2,271
Water Year Types^c												
Wet (23%)	2,505	3,604	6,760	11,512	16,584	16,445	15,425	14,237	11,476	6,916	3,267	3,610
Above Normal (24%)	2,310	2,488	2,775	4,925	6,937	7,444	8,476	5,078	2,579	1,910	1,972	2,341
Below Normal (10%)	2,067	2,299	3,711	3,708	3,857	4,057	6,015	3,856	1,865	1,472	1,454	1,834
Dry (16%)	2,346	2,646	2,309	2,419	2,607	3,241	3,785	2,611	1,568	1,253	1,360	1,782
Critical (27%)	1,991	2,227	1,974	1,842	2,043	2,273	2,247	1,874	1,080	912	1,067	1,497

Alternative 3 minus Revised Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-1%	-1%	0%	9%	0%	0%	1%	1%	3%	7%	18%	-1%
20%	-1%	1%	0%	-1%	0%	5%	-1%	-3%	-3%	-5%	0%	-1%
30%	1%	-2%	-2%	-3%	9%	-1%	0%	0%	-24%	-3%	0%	-1%
40%	0%	1%	0%	6%	-1%	-1%	1%	-3%	-22%	-1%	0%	-1%
50%	2%	-1%	-2%	-2%	-6%	1%	2%	-2%	-11%	0%	0%	0%
60%	3%	1%	2%	0%	0%	-1%	2%	0%	-7%	-2%	0%	0%
70%	5%	2%	1%	1%	-1%	1%	4%	0%	-4%	0%	0%	0%
80%	6%	1%	1%	0%	-3%	2%	5%	8%	-2%	-6%	0%	0%
90%	10%	1%	0%	0%	-4%	4%	7%	5%	-8%	-1%	-3%	-2%
Long Term												
Full Simulation Period ^b	2%	0%	1%	1%	1%	0%	1%	-1%	-8%	0%	0%	0%
Water Year Types^c												
Wet (23%)	1%	0%	2%	0%	2%	0%	0%	-2%	-4%	1%	1%	1%
Above Normal (24%)	3%	1%	2%	1%	0%	1%	1%	-2%	-22%	-4%	0%	0%
Below Normal (10%)	1%	-1%	-1%	4%	1%	0%	1%	-3%	-8%	0%	0%	-1%
Dry (16%)	2%	0%	0%	0%	-1%	0%	4%	-1%	-6%	-1%	0%	0%
Critical (27%)	3%	1%	1%	-1%	-2%	2%	8%	5%	-3%	-4%	-1%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.10.4 San Joaquin River at Vernalis, Monthly Flow

Revised Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,058	3,088	4,931	11,054	17,256	15,467	14,774	14,101	9,720	6,052	2,996	3,315
20%	2,699	2,813	2,924	4,859	10,259	9,401	10,359	8,202	4,768	2,636	2,599	2,659
30%	2,470	2,631	2,462	3,635	6,228	7,841	8,536	5,452	3,364	1,988	1,896	2,484
40%	2,326	2,448	2,299	2,606	4,252	5,343	7,507	4,488	2,947	1,742	1,675	2,152
50%	2,089	2,342	2,226	2,481	3,420	3,825	6,018	3,916	2,205	1,503	1,499	1,934
60%	1,895	2,218	2,100	2,247	2,681	3,460	4,432	2,913	1,824	1,384	1,415	1,837
70%	1,697	2,100	1,988	2,070	2,379	2,870	3,224	2,493	1,420	1,170	1,322	1,743
80%	1,511	1,954	1,866	1,827	2,153	2,327	2,452	1,994	1,271	1,087	1,211	1,611
90%	1,338	1,753	1,671	1,638	1,931	2,115	1,813	1,564	1,085	941	1,099	1,503
Long Term												
Full Simulation Period ^b	2,200	2,673	3,455	5,082	6,806	7,116	7,330	5,903	4,350	2,668	1,876	2,266
Water Year Types^c												
Wet (23%)	2,472	3,596	6,642	11,484	16,260	16,444	15,398	14,493	12,009	6,823	3,227	3,582
Above Normal (24%)	2,234	2,469	2,712	4,887	6,916	7,376	8,371	5,184	3,310	1,997	1,976	2,348
Below Normal (10%)	2,052	2,330	3,742	3,561	3,837	4,077	5,974	3,968	2,025	1,478	1,455	1,847
Dry (16%)	2,305	2,644	2,306	2,421	2,623	3,227	3,656	2,625	1,661	1,266	1,362	1,783
Critical (27%)	1,926	2,205	1,952	1,854	2,092	2,228	2,079	1,780	1,114	951	1,077	1,490

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,495	2,953	4,804	11,129	14,597	15,473	14,976	14,176	9,351	5,773	2,776	3,084
20%	3,146	2,777	2,897	4,811	10,142	9,856	10,265	8,232	4,688	2,628	2,589	2,654
30%	2,938	2,527	2,401	3,610	6,118	8,461	8,576	5,670	3,364	1,985	1,904	2,488
40%	2,763	2,395	2,204	2,629	4,232	5,570	7,567	5,162	2,947	1,735	1,666	2,125
50%	2,588	2,219	2,101	2,402	3,420	3,846	6,110	4,183	2,219	1,484	1,488	1,930
60%	2,385	2,169	2,046	2,289	2,683	3,459	5,047	3,554	1,860	1,365	1,402	1,835
70%	2,196	2,059	1,979	2,083	2,303	2,906	4,317	2,916	1,447	1,155	1,307	1,739
80%	1,988	1,951	1,829	1,883	2,145	2,371	3,100	2,401	1,283	1,052	1,202	1,611
90%	1,849	1,763	1,669	1,699	1,947	2,204	2,461	2,245	1,000	885	1,025	1,431
Long Term												
Full Simulation Period ^b	2,660	2,609	3,371	5,071	6,639	7,235	7,686	6,290	4,174	2,597	1,818	2,213
Water Year Types^c												
Wet (23%)	2,903	3,513	6,448	11,445	15,743	16,679	15,389	14,666	11,287	6,580	3,020	3,379
Above Normal (24%)	2,691	2,411	2,679	4,897	6,864	7,536	8,487	5,671	3,280	1,989	1,975	2,345
Below Normal (10%)	2,531	2,249	3,661	3,506	3,650	4,149	6,299	4,206	2,062	1,462	1,446	1,837
Dry (16%)	2,750	2,569	2,232	2,400	2,547	3,241	4,420	3,245	1,672	1,253	1,346	1,776
Critical (27%)	2,418	2,163	1,910	1,871	2,078	2,288	2,741	2,177	1,090	916	1,051	1,480

Alternative 5 minus Revised Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	14%	-4%	-3%	1%	-15%	0%	1%	1%	-4%	-5%	-7%	-7%
20%	17%	-1%	-1%	-1%	-1%	5%	-1%	0%	-2%	0%	0%	0%
30%	19%	-4%	-3%	-1%	-2%	8%	0%	4%	0%	0%	0%	0%
40%	19%	-2%	-4%	1%	0%	4%	1%	15%	0%	0%	-1%	-1%
50%	24%	-5%	-6%	-3%	0%	1%	2%	7%	1%	-1%	-1%	0%
60%	26%	-2%	-3%	2%	0%	0%	14%	22%	2%	-1%	-1%	0%
70%	29%	-2%	0%	1%	-3%	1%	34%	17%	2%	-1%	-1%	0%
80%	32%	0%	-2%	3%	0%	2%	26%	20%	1%	-3%	-1%	0%
90%	38%	1%	0%	4%	1%	4%	36%	44%	-8%	-6%	-7%	-5%
Long Term												
Full Simulation Period ^b	21%	-2%	-2%	0%	-2%	2%	5%	7%	-4%	-3%	-3%	-2%
Water Year Types^c												
Wet (23%)	17%	-2%	-3%	0%	-3%	1%	0%	1%	-6%	-4%	-6%	-6%
Above Normal (24%)	20%	-2%	-1%	0%	-1%	2%	1%	9%	-1%	0%	0%	0%
Below Normal (10%)	23%	-3%	-2%	-2%	-5%	2%	5%	6%	2%	-1%	-1%	-1%
Dry (16%)	19%	-3%	-3%	-1%	-3%	0%	21%	24%	1%	-1%	-1%	0%
Critical (27%)	26%	-2%	-2%	1%	-1%	3%	32%	22%	-2%	-4%	-2%	-1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

5C.3.2.11 Old and Middle River Flow

Table 5C.3.2.11.1 Sacramento/San Joaquin River Delta Outflow, Monthly Outflow Volume

No Action Alternative

Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	614	893	4,094	6,333	7,834	5,445	4,160	2,848	1,180	763	277	1,161
20%	586	874	2,112	4,323	4,927	4,179	2,834	1,727	609	688	259	1,134
30%	576	825	1,003	3,149	3,624	2,834	1,795	1,200	548	573	246	909
40%	423	657	761	1,793	2,868	2,092	1,504	1,004	465	497	246	656
50%	270	586	611	1,299	2,037	1,676	1,197	843	431	492	246	261
60%	246	368	359	1,050	1,407	1,204	946	731	422	400	246	201
70%	246	268	315	800	1,023	1,061	758	592	408	307	246	179
80%	246	268	278	586	823	783	598	520	383	307	246	179
90%	184	210	277	486	633	662	564	446	334	246	240	179
Long Term												
Full Simulation Period ^b	401	686	1,416	2,720	3,186	2,697	1,812	1,281	648	495	258	565
Water Year Types^c												
Wet (23%)	520	1,020	2,913	5,509	5,771	5,000	3,288	2,394	1,120	655	273	1,133
Above Normal (24%)	332	742	1,502	3,049	3,807	3,236	1,938	1,201	485	667	251	662
Below Normal (10%)	471	650	582	1,077	2,048	1,113	1,019	789	445	508	254	211
Dry (16%)	341	470	471	981	1,443	1,396	999	680	431	315	257	191
Critical (27%)	253	296	418	723	861	747	559	410	348	249	235	179

Revised Alternative 1

Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	373	895	4,048	6,551	8,106	5,795	3,956	2,541	1,141	670	271	259
20%	286	384	2,029	4,469	4,884	4,375	2,589	1,579	658	581	247	240
30%	269	329	947	2,826	3,377	2,686	1,466	952	591	508	246	234
40%	257	291	635	1,561	2,882	2,060	1,215	790	559	492	246	229
50%	246	269	464	1,078	1,898	1,614	859	715	512	461	246	221
60%	246	268	371	829	1,168	1,103	726	675	495	400	246	184
70%	246	268	312	665	918	899	599	560	439	307	246	179
80%	246	268	277	501	720	751	565	533	422	307	236	179
90%	232	208	277	405	596	601	528	437	369	246	215	179
Long Term												
Full Simulation Period ^b	289	508	1,407	2,590	3,140	2,678	1,609	1,159	704	457	252	238
Water Year Types^c												
Wet (23%)	345	794	3,009	5,453	5,819	5,073	3,004	2,182	1,199	607	271	321
Above Normal (24%)	252	566	1,394	2,837	3,821	3,313	1,620	1,021	569	599	250	223
Below Normal (10%)	294	433	540	878	2,078	1,075	812	715	532	429	254	208
Dry (16%)	267	297	433	821	1,268	1,232	879	627	455	310	244	191
Critical (27%)	241	244	367	640	692	680	525	385	346	247	229	179

Revised Alternative 1 minus No Action Alternative

Statistic	Monthly Outflow Volume (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-39%	0%	-1%	3%	3%	6%	-5%	-11%	-3%	-12%	-2%	-78%
20%	-51%	-56%	-4%	3%	-1%	5%	-9%	-9%	8%	-16%	-5%	-79%
30%	-53%	-60%	-6%	-10%	-7%	-5%	-18%	-21%	8%	-11%	0%	-74%
40%	-39%	-56%	-17%	-13%	0%	-2%	-19%	-21%	20%	-1%	0%	-65%
50%	-9%	-54%	-24%	-17%	-7%	-4%	-28%	-15%	19%	-6%	0%	-15%
60%	0%	-27%	4%	-21%	-17%	-8%	-23%	-8%	17%	0%	0%	-8%
70%	0%	0%	-1%	-17%	-10%	-15%	-21%	-5%	7%	0%	0%	0%
80%	0%	0%	0%	-14%	-13%	-4%	-6%	2%	10%	0%	-4%	0%
90%	26%	-1%	0%	-17%	-6%	-9%	-6%	-2%	11%	0%	-10%	0%
Long Term												
Full Simulation Period ^b	-28%	-26%	-1%	-5%	-1%	-1%	-11%	-10%	9%	-8%	-2%	-58%
Water Year Types^c												
Wet (23%)	-34%	-22%	3%	-1%	1%	1%	-9%	-9%	7%	-7%	-1%	-72%
Above Normal (24%)	-24%	-24%	-7%	-7%	0%	2%	-16%	-15%	17%	-10%	-1%	-66%
Below Normal (10%)	-38%	-33%	-7%	-18%	1%	-3%	-20%	-9%	20%	-16%	0%	-1%
Dry (16%)	-22%	-37%	-8%	-16%	-12%	-12%	-12%	-8%	6%	-2%	-5%	0%
Critical (27%)	-5%	-18%	-12%	-12%	-20%	-9%	-6%	-6%	-1%	-1%	-3%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.11.2 Sacramento/San Joaquin River Delta Outflow, Monthly Outflow Volume

Revised Second Basis of Comparison

Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	373	895	4,048	6,551	8,106	5,795	3,956	2,541	1,141	670	271	259
20%	286	384	2,029	4,469	4,884	4,375	2,589	1,579	658	581	247	240
30%	269	329	947	2,826	3,377	2,686	1,466	952	591	508	246	234
40%	257	291	635	1,561	2,882	2,060	1,215	790	559	492	246	229
50%	246	269	464	1,078	1,898	1,614	859	715	512	461	246	221
60%	246	268	371	829	1,168	1,103	726	675	495	400	246	184
70%	246	268	312	665	918	899	599	560	439	307	246	179
80%	246	268	277	501	720	751	565	533	422	307	236	179
90%	232	208	277	405	596	601	528	437	369	246	215	179
Long Term												
Full Simulation Period ^b	289	508	1,407	2,590	3,140	2,678	1,609	1,159	704	457	252	238
Water Year Types^c												
Wet (23%)	345	794	3,009	5,453	5,819	5,073	3,004	2,182	1,199	607	271	321
Above Normal (24%)	252	566	1,394	2,837	3,821	3,313	1,620	1,021	569	599	250	223
Below Normal (10%)	294	433	540	878	2,078	1,075	812	715	532	429	254	208
Dry (16%)	267	297	433	821	1,268	1,232	879	627	455	310	244	191
Critical (27%)	241	244	367	640	692	680	525	385	346	247	229	179

No Action Alternative

Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	614	893	4,094	6,333	7,834	5,445	4,160	2,848	1,180	763	277	1,161
20%	586	874	2,112	4,323	4,927	4,179	2,834	1,727	609	688	259	1,134
30%	576	825	1,003	3,149	3,624	2,834	1,795	1,200	548	573	246	909
40%	423	657	761	1,793	2,868	2,092	1,504	1,004	465	497	246	656
50%	270	586	611	1,299	2,037	1,676	1,197	843	431	492	246	261
60%	246	368	359	1,050	1,407	1,204	946	731	422	400	246	201
70%	246	268	315	800	1,023	1,061	758	592	408	307	246	179
80%	246	268	278	586	823	783	598	520	383	307	246	179
90%	184	210	277	486	633	662	564	446	334	246	240	179
Long Term												
Full Simulation Period ^b	401	686	1,416	2,720	3,186	2,697	1,812	1,281	648	495	258	565
Water Year Types^c												
Wet (23%)	520	1,020	2,913	5,509	5,771	5,000	3,288	2,394	1,120	655	273	1,133
Above Normal (24%)	332	742	1,502	3,049	3,807	3,236	1,938	1,201	485	667	251	662
Below Normal (10%)	471	650	582	1,077	2,048	1,113	1,019	789	445	508	254	211
Dry (16%)	341	470	471	981	1,443	1,396	999	680	431	315	257	191
Critical (27%)	253	296	418	723	861	747	559	410	348	249	235	179

No Action Alternative minus Revised Second Basis of Comparison

Statistic	Monthly Outflow Volume (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	65%	0%	1%	-3%	-3%	-6%	5%	12%	3%	14%	2%	349%
20%	105%	128%	4%	-3%	1%	-4%	9%	9%	-7%	18%	5%	372%
30%	114%	151%	6%	11%	7%	6%	22%	26%	-7%	13%	0%	288%
40%	64%	126%	20%	15%	0%	2%	24%	27%	-17%	1%	0%	187%
50%	10%	118%	32%	20%	7%	4%	39%	18%	-16%	7%	0%	18%
60%	0%	37%	-3%	27%	20%	9%	30%	8%	-15%	0%	0%	9%
70%	0%	0%	1%	20%	11%	18%	26%	6%	-7%	0%	0%	0%
80%	0%	0%	0%	17%	14%	4%	6%	-2%	-9%	0%	4%	0%
90%	-20%	1%	0%	20%	6%	10%	7%	2%	-10%	0%	11%	0%
Long Term												
Full Simulation Period ^b	39%	35%	1%	5%	1%	1%	13%	11%	-8%	8%	2%	138%
Water Year Types^c												
Wet (23%)	51%	28%	-3%	1%	-1%	-1%	9%	10%	-7%	8%	1%	253%
Above Normal (24%)	32%	31%	8%	8%	0%	-2%	20%	18%	-15%	11%	1%	197%
Below Normal (10%)	60%	50%	8%	23%	-1%	4%	25%	10%	-16%	18%	0%	2%
Dry (16%)	28%	58%	9%	19%	14%	13%	14%	8%	-5%	2%	5%	0%
Critical (27%)	5%	21%	14%	13%	24%	10%	6%	6%	1%	1%	3%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.11.3 Sacramento/San Joaquin River Delta Outflow, Monthly Outflow Volume

Revised Second Basis of Comparison

Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	373	895	4,048	6,551	8,106	5,795	3,956	2,541	1,141	670	271	259
20%	286	384	2,029	4,469	4,884	4,375	2,589	1,579	658	581	247	240
30%	269	329	947	2,826	3,377	2,686	1,466	952	591	508	246	234
40%	257	291	635	1,561	2,882	2,060	1,215	790	559	492	246	229
50%	246	269	464	1,078	1,898	1,614	859	715	512	461	246	221
60%	246	268	371	829	1,168	1,103	726	675	495	400	246	184
70%	246	268	312	665	918	899	599	560	439	307	246	179
80%	246	268	277	501	720	751	565	533	422	307	236	179
90%	232	208	277	405	596	601	528	437	369	246	215	179
Long Term												
Full Simulation Period ^b	289	508	1,407	2,590	3,140	2,678	1,609	1,159	704	457	252	238
Water Year Types^c												
Wet (23%)	345	794	3,009	5,453	5,819	5,073	3,004	2,182	1,199	607	271	321
Above Normal (24%)	252	566	1,394	2,837	3,821	3,313	1,620	1,021	569	599	250	223
Below Normal (10%)	294	433	540	878	2,078	1,075	812	715	532	429	254	208
Dry (16%)	267	297	433	821	1,268	1,232	879	627	455	310	244	191
Critical (27%)	241	244	367	640	692	680	525	385	346	247	229	179

Alternative 3

Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	298	902	4,155	6,646	7,924	5,788	3,812	2,471	1,066	729	265	261
20%	266	389	2,140	4,462	4,802	4,293	2,584	1,383	630	659	246	245
30%	257	319	1,154	3,104	3,795	2,714	1,525	913	572	575	246	235
40%	246	290	722	1,875	3,031	2,137	1,238	750	502	492	246	229
50%	246	268	480	1,398	2,079	1,678	867	704	477	492	246	222
60%	246	268	398	1,061	1,416	1,185	754	630	436	428	246	191
70%	246	268	336	768	1,078	1,032	601	579	422	307	246	179
80%	246	268	277	599	821	789	566	493	409	307	241	179
90%	185	208	277	497	634	654	512	437	351	246	222	179
Long Term												
Full Simulation Period ^b	277	506	1,465	2,772	3,236	2,711	1,617	1,122	656	490	252	240
Water Year Types^c												
Wet (23%)	333	791	3,116	5,609	5,812	5,020	2,996	2,109	1,118	649	271	319
Above Normal (24%)	242	568	1,461	3,096	3,903	3,292	1,636	960	514	645	246	228
Below Normal (10%)	281	422	564	1,156	2,186	1,120	856	699	457	507	254	221
Dry (16%)	250	297	457	992	1,459	1,384	882	612	445	321	245	191
Critical (27%)	234	243	397	721	859	752	528	397	346	246	230	179

Alternative 3 minus Revised Second Basis of Comparison

Statistic	Monthly Outflow Volume (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-20%	1%	3%	1%	-2%	0%	-4%	-3%	-7%	9%	-2%	1%
20%	-7%	1%	5%	0%	-2%	-2%	0%	-12%	-4%	13%	0%	2%
30%	-5%	-3%	22%	10%	12%	1%	4%	-4%	-3%	13%	0%	0%
40%	-4%	0%	14%	20%	5%	4%	2%	-5%	-10%	0%	0%	0%
50%	0%	0%	4%	30%	10%	4%	1%	-2%	-7%	7%	0%	0%
60%	0%	0%	7%	28%	21%	7%	4%	-7%	-12%	7%	0%	3%
70%	0%	0%	8%	15%	17%	15%	0%	3%	-4%	0%	0%	0%
80%	0%	0%	0%	20%	14%	5%	0%	-7%	-3%	0%	2%	0%
90%	-20%	0%	0%	23%	7%	9%	-3%	0%	-5%	0%	3%	0%
Long Term												
Full Simulation Period ^b	-4%	0%	4%	7%	3%	1%	0%	-3%	-7%	7%	0%	1%
Water Year Types^c												
Wet (23%)	-3%	0%	4%	3%	0%	-1%	0%	-3%	-7%	7%	0%	0%
Above Normal (24%)	-4%	0%	5%	9%	2%	-1%	1%	-6%	-10%	8%	-1%	2%
Below Normal (10%)	-4%	-3%	4%	32%	5%	4%	5%	-2%	-14%	18%	0%	6%
Dry (16%)	-6%	0%	5%	21%	15%	12%	0%	-2%	-2%	4%	0%	0%
Critical (27%)	-3%	0%	8%	13%	24%	11%	1%	3%	0%	-1%	1%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.11.4 Sacramento/San Joaquin River Delta Outflow, Monthly Outflow Volume

Revised Second Basis of Comparison

Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	373	895	4,048	6,551	8,106	5,795	3,956	2,541	1,141	670	271	259
20%	286	384	2,029	4,469	4,884	4,375	2,589	1,579	658	581	247	240
30%	269	329	947	2,826	3,377	2,686	1,466	952	591	508	246	234
40%	257	291	635	1,561	2,882	2,060	1,215	790	559	492	246	229
50%	246	269	464	1,078	1,898	1,614	859	715	512	461	246	221
60%	246	268	371	829	1,168	1,103	726	675	495	400	246	184
70%	246	268	312	665	918	899	599	560	439	307	246	179
80%	246	268	277	501	720	751	565	533	422	307	236	179
90%	232	208	277	405	596	601	528	437	369	246	215	179
Long Term												
Full Simulation Period ^b	289	508	1,407	2,590	3,140	2,678	1,609	1,159	704	457	252	238
Water Year Types^c												
Wet (23%)	345	794	3,009	5,453	5,819	5,073	3,004	2,182	1,199	607	271	321
Above Normal (24%)	252	566	1,394	2,837	3,821	3,313	1,620	1,021	569	599	250	223
Below Normal (10%)	294	433	540	878	2,078	1,075	812	715	532	429	254	208
Dry (16%)	267	297	433	821	1,268	1,232	879	627	455	310	244	191
Critical (27%)	241	244	367	640	692	680	525	385	346	247	229	179

Alternative 5

Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	623	960	4,115	6,339	7,831	5,439	4,160	2,849	1,180	767	284	1,161
20%	594	874	2,112	4,319	4,907	4,174	2,807	1,763	606	688	256	1,134
30%	576	830	1,008	3,149	3,653	2,835	1,798	1,237	524	593	246	910
40%	423	660	762	1,785	2,869	2,092	1,542	1,002	453	501	246	651
50%	257	586	616	1,301	2,053	1,666	1,234	873	423	492	246	255
60%	246	369	359	1,048	1,406	1,203	1,028	776	422	400	246	204
70%	246	268	310	800	1,025	1,057	817	629	401	308	246	179
80%	246	268	286	585	823	783	712	561	370	307	246	179
90%	184	211	277	486	633	662	623	462	330	246	230	179
Long Term												
Full Simulation Period ^b	401	690	1,413	2,714	3,184	2,695	1,848	1,312	642	500	257	565
Water Year Types^c												
Wet (23%)	517	1,020	2,905	5,499	5,773	4,996	3,288	2,411	1,117	667	273	1,132
Above Normal (24%)	334	767	1,505	3,048	3,795	3,232	1,947	1,223	482	668	251	661
Below Normal (10%)	471	650	582	1,075	2,047	1,110	1,061	821	434	513	254	214
Dry (16%)	342	471	467	980	1,444	1,396	1,081	720	423	316	256	191
Critical (27%)	254	296	418	714	856	747	621	462	346	249	233	179

Alternative 5 minus Revised Second Basis of Comparison

Statistic	Monthly Outflow Volume (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	67%	7%	2%	-3%	-3%	-6%	5%	12%	3%	14%	5%	349%
20%	108%	128%	4%	-3%	0%	-5%	8%	12%	-8%	18%	4%	372%
30%	114%	152%	7%	11%	8%	6%	23%	30%	-11%	17%	0%	288%
40%	64%	127%	20%	14%	0%	2%	27%	27%	-19%	2%	0%	185%
50%	5%	118%	33%	21%	8%	3%	44%	22%	-17%	7%	0%	16%
60%	0%	38%	-3%	26%	20%	9%	42%	15%	-15%	0%	0%	10%
70%	0%	0%	-1%	20%	12%	18%	36%	12%	-9%	0%	0%	0%
80%	0%	0%	3%	17%	14%	4%	26%	5%	-12%	0%	4%	0%
90%	-20%	1%	0%	20%	6%	10%	18%	6%	-11%	0%	7%	0%
Long Term												
Full Simulation Period ^b	39%	36%	0%	5%	1%	1%	15%	13%	-9%	9%	2%	138%
Water Year Types^c												
Wet (23%)	50%	28%	-3%	1%	-1%	-2%	9%	11%	-7%	10%	1%	253%
Above Normal (24%)	32%	36%	8%	7%	-1%	-2%	20%	20%	-15%	11%	1%	197%
Below Normal (10%)	60%	50%	8%	22%	-1%	3%	31%	15%	-18%	20%	0%	3%
Dry (16%)	28%	59%	8%	19%	14%	13%	23%	15%	-7%	2%	5%	0%
Critical (27%)	5%	21%	14%	12%	24%	10%	18%	20%	0%	1%	2%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

5C.3.2.12 X2 Position

Table 5C.3.2.12.1 X2, End of Month Position

No Action Alternative

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	93.4	93.6	90.8	84.0	77.3	75.9	78.1	81.0	83.1	86.5	89.7	91.9
20%	91.8	91.4	87.6	82.3	71.7	72.8	73.6	79.3	81.8	84.9	88.1	91.1
30%	91.6	90.9	83.9	79.8	67.2	65.7	70.0	77.3	81.0	84.3	87.5	90.6
40%	91.1	88.1	82.5	73.5	64.0	64.5	66.7	72.3	80.2	82.4	86.2	90.1
50%	89.7	81.1	81.1	71.2	58.5	59.9	64.7	69.9	77.8	80.6	84.8	88.5
60%	81.0	81.0	79.7	64.4	55.2	58.0	60.9	66.3	76.6	78.1	84.6	81.0
70%	74.1	75.1	72.0	55.1	51.9	53.9	58.0	63.8	73.4	77.4	84.1	74.1
80%	74.0	74.0	62.2	51.3	49.4	50.6	53.8	59.1	69.8	76.8	82.7	74.0
90%	74.0	74.0	52.8	49.4	48.2	49.0	49.9	53.3	63.5	74.6	82.2	74.0
Long Term												
Full Simulation Period ^b	84.2	82.3	76.4	68.0	61.1	61.4	64.2	68.8	75.9	80.4	85.4	83.9
Water Year Types ^c												
Wet (23%)	80.6	76.8	63.7	54.8	51.2	53.1	55.1	58.4	67.4	74.9	82.7	73.9
Above Normal (24%)	86.9	82.4	75.1	61.0	54.9	55.3	59.1	65.2	75.3	77.9	83.1	74.7
Below Normal (10%)	80.4	80.3	80.4	74.6	64.3	66.9	69.0	72.9	79.1	81.1	85.1	89.3
Dry (16%)	85.6	85.5	84.5	77.7	67.7	65.4	68.8	74.5	80.1	84.5	87.6	90.5
Critical (27%)	90.4	90.7	88.2	82.0	75.3	74.6	77.7	82.3	85.2	87.9	90.3	92.1

Revised Alternative 1

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	92.3	92.5	91.0	87.3	80.4	78.2	78.5	81.5	83.5	86.6	90.0	92.1
20%	91.8	91.3	90.6	85.9	75.6	73.5	75.2	79.6	81.6	84.8	88.5	91.4
30%	91.2	91.0	89.5	83.6	72.1	68.3	73.3	78.6	80.5	84.3	88.0	90.8
40%	91.0	90.8	88.7	78.9	66.2	66.6	69.7	75.4	78.6	82.1	86.5	90.1
50%	90.6	90.3	86.8	75.6	61.5	61.7	67.3	72.9	77.9	81.1	85.6	89.4
60%	90.2	89.6	82.5	67.7	55.7	57.8	64.2	70.3	76.1	78.9	84.7	89.0
70%	90.0	89.0	77.0	56.3	52.4	54.0	59.9	66.0	74.4	78.2	84.4	88.6
80%	89.6	88.0	65.9	51.9	49.4	50.4	54.7	60.2	71.4	77.3	84.1	88.4
90%	87.3	79.7	53.3	49.5	48.2	48.8	50.4	54.6	64.1	74.8	83.0	87.8
Long Term												
Full Simulation Period ^b	90.0	87.6	79.5	70.4	62.8	62.3	65.9	70.6	75.8	80.7	86.0	89.3
Water Year Types ^c												
Wet (23%)	88.1	83.7	66.3	55.7	51.6	53.0	56.4	60.3	67.3	75.3	83.3	86.6
Above Normal (24%)	91.0	87.1	79.1	63.6	56.1	55.2	61.1	67.9	75.0	78.2	83.8	81.9
Below Normal (10%)	89.6	87.3	84.5	78.8	66.0	67.3	71.3	74.9	78.2	81.4	86.0	89.7
Dry (16%)	90.7	90.4	87.9	81.1	70.7	67.6	70.8	76.0	80.2	84.4	88.0	90.8
Critical (27%)	91.9	92.1	90.0	84.0	78.5	76.8	78.8	83.3	85.7	88.2	90.6	92.4

Revised Alternative 1 minus No Action Alternative

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-1.1	-1.1	0.2	3.3	3.1	2.3	0.4	0.5	0.3	0.1	0.3	0.1
20%	0.0	-0.1	2.9	3.6	3.9	0.7	1.6	0.3	-0.1	-0.1	0.4	0.3
30%	-0.4	0.1	5.5	3.8	4.8	2.6	3.2	1.3	-0.5	0.1	0.5	0.3
40%	-0.1	2.7	6.2	5.4	2.2	2.1	3.0	3.1	-1.6	-0.2	0.3	0.0
50%	0.9	9.2	5.7	4.4	3.0	1.8	2.6	3.0	0.2	0.5	0.8	0.9
60%	9.2	8.6	2.7	3.3	0.6	-0.2	3.3	4.0	-0.6	0.8	0.1	8.0
70%	15.9	13.9	5.1	1.1	0.5	0.1	1.9	2.2	1.0	0.8	0.3	14.6
80%	15.6	13.9	3.6	0.6	0.0	-0.2	0.9	1.1	1.5	0.5	1.4	14.4
90%	13.3	5.8	0.5	0.1	0.0	-0.2	0.5	1.2	0.7	0.2	0.7	13.8
Long Term												
Full Simulation Period ^b	5.7	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
Water Year Types ^c												
Wet (23%)	7.5	6.9	2.7	1.0	0.4	0.0	1.3	1.9	0.0	0.4	0.5	12.7
Above Normal (24%)	4.1	4.6	4.0	2.7	1.2	0.0	2.0	2.7	-0.3	0.3	0.7	7.2
Below Normal (10%)	9.2	7.0	4.1	4.2	1.7	0.5	2.3	2.0	-0.9	0.3	0.9	0.4
Dry (16%)	5.1	4.9	3.5	3.4	3.1	2.2	2.0	1.5	0.1	-0.1	0.4	0.3
Critical (27%)	1.4	1.4	1.8	2.1	3.2	2.2	1.2	1.0	0.5	0.3	0.3	0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.12.2 X2, End of Month Position

Revised Second Basis of Comparison

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	92.3	92.5	91.0	87.3	80.4	78.2	78.5	81.5	83.5	86.6	90.0	92.1
20%	91.8	91.3	90.6	85.9	75.6	73.5	75.2	79.6	81.6	84.8	88.5	91.4
30%	91.2	91.0	89.5	83.6	72.1	68.3	73.3	78.6	80.5	84.3	88.0	90.8
40%	91.0	90.8	88.7	78.9	66.2	66.6	69.7	75.4	78.6	82.1	86.5	90.1
50%	90.6	90.3	86.8	75.6	61.5	61.7	67.3	72.9	77.9	81.1	85.6	89.4
60%	90.2	89.6	82.5	67.7	55.7	57.8	64.2	70.3	76.1	78.9	84.7	89.0
70%	90.0	89.0	77.0	56.3	52.4	54.0	59.9	66.0	74.4	78.2	84.4	88.6
80%	89.6	88.0	65.9	51.9	49.4	50.4	54.7	60.2	71.4	77.3	84.1	88.4
90%	87.3	79.7	53.3	49.5	48.2	48.8	50.4	54.6	64.1	74.8	83.0	87.8
Long Term												
Full Simulation Period ^b	90.0	87.6	79.5	70.4	62.8	62.3	65.9	70.6	75.8	80.7	86.0	89.3
Water Year Types^c												
Wet (23%)	88.1	83.7	66.3	55.7	51.6	53.0	56.4	60.3	67.3	75.3	83.3	86.6
Above Normal (24%)	91.0	87.1	79.1	63.6	56.1	55.2	61.1	67.9	75.0	78.2	83.8	81.9
Below Normal (10%)	89.6	87.3	84.5	78.8	66.0	67.3	71.3	74.9	78.2	81.4	86.0	89.7
Dry (16%)	90.7	90.4	87.9	81.1	70.7	67.6	70.8	76.0	80.2	84.4	88.0	90.8
Critical (27%)	91.9	92.1	90.0	84.0	78.5	76.8	78.8	83.3	85.7	88.2	90.6	92.4

No Action Alternative

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	93.4	93.6	90.8	84.0	77.3	75.9	78.1	81.0	83.1	86.5	89.7	91.9
20%	91.8	91.4	87.6	82.3	71.7	72.8	73.6	79.3	81.8	84.9	88.1	91.1
30%	91.6	90.9	83.9	79.8	67.2	65.7	70.0	77.3	81.0	84.3	87.5	90.6
40%	91.1	88.1	82.5	73.5	64.0	64.5	66.7	72.3	80.2	82.4	86.2	90.1
50%	89.7	81.1	81.1	71.2	58.5	59.9	64.7	69.9	77.8	80.6	84.8	88.5
60%	81.0	81.0	79.7	64.4	55.2	58.0	60.9	66.3	76.6	78.1	84.6	81.0
70%	74.1	75.1	72.0	55.1	51.9	53.9	58.0	63.8	73.4	77.4	84.1	74.1
80%	74.0	74.0	62.2	51.3	49.4	50.6	53.8	59.1	69.8	76.8	82.7	74.0
90%	74.0	74.0	52.8	49.4	48.2	49.0	49.9	53.3	63.5	74.6	82.2	74.0
Long Term												
Full Simulation Period ^b	84.2	82.3	76.4	68.0	61.1	61.4	64.2	68.8	75.9	80.4	85.4	83.9
Water Year Types^c												
Wet (23%)	80.6	76.8	63.7	54.8	51.2	53.1	55.1	58.4	67.4	74.9	82.7	73.9
Above Normal (24%)	86.9	82.4	75.1	61.0	54.9	55.3	59.1	65.2	75.3	77.9	83.1	74.7
Below Normal (10%)	80.4	80.3	80.4	74.6	64.3	66.9	69.0	72.9	79.1	81.1	85.1	89.3
Dry (16%)	85.6	85.5	84.5	77.7	67.7	65.4	68.8	74.5	80.1	84.5	87.6	90.5
Critical (27%)	90.4	90.7	88.2	82.0	75.3	74.6	77.7	82.3	85.2	87.9	90.3	92.1

No Action Alternative minus Revised Second Basis of Comparison

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1.1	1.1	-0.2	-3.3	-3.1	-2.3	-0.4	-0.5	-0.3	-0.1	-0.3	-0.1
20%	0.0	0.1	-2.9	-3.6	-3.9	-0.7	-1.6	-0.3	0.1	0.1	-0.4	-0.3
30%	0.4	-0.1	-5.5	-3.8	-4.8	-2.6	-3.2	-1.3	0.5	-0.1	-0.5	-0.3
40%	0.1	-2.7	-6.2	-5.4	-2.2	-2.1	-3.0	-3.1	1.6	0.2	-0.3	0.0
50%	-0.9	-9.2	-5.7	-4.4	-3.0	-1.8	-2.6	-3.0	-0.2	-0.5	-0.8	-0.9
60%	-9.2	-8.6	-2.7	-3.3	-0.6	0.2	-3.3	-4.0	0.6	-0.8	-0.1	-8.0
70%	-15.9	-13.9	-5.1	-1.1	-0.5	-0.1	-1.9	-2.2	-1.0	-0.8	-0.3	-14.6
80%	-15.6	-13.9	-3.6	-0.6	0.0	0.2	-0.9	-1.1	-1.5	-0.5	-1.4	-14.4
90%	-13.3	-5.8	-0.5	-0.1	0.0	0.2	-0.5	-1.2	-0.7	-0.2	-0.7	-13.8
Long Term												
Full Simulation Period ^b	-5.7	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
Water Year Types^c												
Wet (23%)	-7.5	-6.9	-2.7	-1.0	-0.4	0.0	-1.3	-1.9	0.0	-0.4	-0.5	-12.7
Above Normal (24%)	-4.1	-4.6	-4.0	-2.7	-1.2	0.0	-2.0	-2.7	0.3	-0.3	-0.7	-7.2
Below Normal (10%)	-9.2	-7.0	-4.1	-4.2	-1.7	-0.5	-2.3	-2.0	0.9	-0.3	-0.9	-0.4
Dry (16%)	-5.1	-4.9	-3.5	-3.4	-3.1	-2.2	-2.0	-1.5	-0.1	0.1	-0.4	-0.3
Critical (27%)	-1.4	-1.4	-1.8	-2.1	-3.2	-2.2	-1.2	-1.0	-0.5	-0.3	-0.3	-0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.12.3 X2, End of Month Position

Revised Second Basis of Comparison

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	92.3	92.5	91.0	87.3	80.4	78.2	78.5	81.5	83.5	86.6	90.0	92.1
20%	91.8	91.3	90.6	85.9	75.6	73.5	75.2	79.6	81.6	84.8	88.5	91.4
30%	91.2	91.0	89.5	83.6	72.1	68.3	73.3	78.6	80.5	84.3	88.0	90.8
40%	91.0	90.8	88.7	78.9	66.2	66.6	69.7	75.4	78.6	82.1	86.5	90.1
50%	90.6	90.3	86.8	75.6	61.5	61.7	67.3	72.9	77.9	81.1	85.6	89.4
60%	90.2	89.6	82.5	67.7	55.7	57.8	64.2	70.3	76.1	78.9	84.7	89.0
70%	90.0	89.0	77.0	56.3	52.4	54.0	59.9	66.0	74.4	78.2	84.4	88.6
80%	89.6	88.0	65.9	51.9	49.4	50.4	54.7	60.2	71.4	77.3	84.1	88.4
90%	87.3	79.7	53.3	49.5	48.2	48.8	50.4	54.6	64.1	74.8	83.0	87.8
Long Term												
Full Simulation Period ^b	90.0	87.6	79.5	70.4	62.8	62.3	65.9	70.6	75.8	80.7	86.0	89.3
Water Year Types^c												
Wet (23%)	88.1	83.7	66.3	55.7	51.6	53.0	56.4	60.3	67.3	75.3	83.3	86.6
Above Normal (24%)	91.0	87.1	79.1	63.6	56.1	55.2	61.1	67.9	75.0	78.2	83.8	81.9
Below Normal (10%)	89.6	87.3	84.5	78.8	66.0	67.3	71.3	74.9	78.2	81.4	86.0	89.7
Dry (16%)	90.7	90.4	87.9	81.1	70.7	67.6	70.8	76.0	80.2	84.4	88.0	90.8
Critical (27%)	91.9	92.1	90.0	84.0	78.5	76.8	78.8	83.3	85.7	88.2	90.6	92.4

Alternative 3

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	93.2	93.6	90.8	86.1	77.8	75.8	78.2	81.5	83.2	86.4	90.0	92.2
20%	91.9	91.5	90.5	83.7	71.7	72.5	74.6	79.6	82.0	84.8	88.4	91.3
30%	91.6	91.1	89.4	81.5	67.6	66.1	71.3	78.4	81.0	84.3	87.7	90.8
40%	91.2	90.8	88.5	74.8	64.1	64.5	69.7	75.6	80.3	81.7	86.0	89.8
50%	90.7	90.6	86.7	71.8	58.8	60.0	67.3	73.1	78.8	80.7	84.9	89.3
60%	90.2	89.8	82.6	64.6	54.4	58.0	63.6	70.4	77.1	78.4	84.6	88.7
70%	89.9	89.0	74.2	55.1	52.2	54.4	59.9	66.8	75.1	77.8	84.2	88.4
80%	89.6	87.9	65.1	51.2	49.3	50.4	54.8	61.7	71.8	77.1	83.2	88.2
90%	88.2	79.6	53.0	49.5	48.1	48.8	50.4	54.8	64.9	75.0	82.4	87.6
Long Term												
Full Simulation Period ^b	90.1	87.8	79.0	68.5	61.2	61.4	65.5	70.8	76.5	80.5	85.6	89.1
Water Year Types^c												
Wet (23%)	88.1	83.9	65.6	54.8	51.3	53.1	56.5	60.8	68.3	75.1	82.9	86.6
Above Normal (24%)	91.2	87.2	78.3	61.5	54.9	55.0	60.9	68.4	76.2	78.0	83.4	81.8
Below Normal (10%)	89.9	87.7	84.4	75.4	64.0	66.6	70.5	74.9	79.6	81.0	85.1	89.2
Dry (16%)	90.8	90.6	87.6	78.8	67.9	65.5	69.9	76.0	80.4	84.3	87.8	90.8
Critical (27%)	92.1	92.2	89.5	82.7	75.6	74.6	78.1	82.8	85.4	88.0	90.5	92.3

Alternative 3 minus Revised Second Basis of Comparison

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.9	1.0	-0.1	-1.2	-2.6	-2.4	-0.3	-0.1	-0.3	-0.2	0.0	0.2
20%	0.2	0.1	-0.1	-2.2	-3.9	-1.0	-0.6	0.0	0.3	0.0	-0.2	-0.1
30%	0.4	0.1	0.0	-2.1	-4.5	-2.2	-2.0	-0.1	0.5	0.0	-0.3	-0.1
40%	0.2	0.1	-0.2	-4.1	-2.0	-2.1	0.0	0.3	1.8	-0.4	-0.5	-0.3
50%	0.1	0.3	-0.1	-3.8	-2.6	-1.7	0.0	0.3	0.9	-0.4	-0.7	-0.1
60%	0.0	0.2	0.2	-3.1	-1.4	0.2	-0.5	0.1	1.1	-0.6	-0.1	-0.3
70%	-0.1	0.0	-2.8	-1.1	-0.2	0.3	-0.1	0.8	0.7	-0.5	-0.1	-0.2
80%	0.0	-0.1	-0.8	-0.7	0.0	0.1	0.1	1.5	0.4	-0.2	-0.8	-0.2
90%	0.8	-0.1	-0.3	0.0	-0.1	0.0	0.0	0.2	0.7	0.1	-0.6	-0.1
Long Term												
Full Simulation Period ^b	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types^c												
Wet (23%)	0.0	0.2	-0.7	-0.9	-0.3	0.1	0.0	0.5	1.0	-0.2	-0.4	-0.1
Above Normal (24%)	0.3	0.1	-0.8	-2.2	-1.2	-0.2	-0.2	0.5	1.1	-0.2	-0.4	-0.2
Below Normal (10%)	0.4	0.4	-0.1	-3.4	-2.0	-0.8	-0.7	0.0	1.4	-0.4	-0.8	-0.5
Dry (16%)	0.1	0.2	-0.3	-2.3	-2.8	-2.1	-0.8	0.0	0.3	-0.1	-0.2	-0.1
Critical (27%)	0.2	0.2	-0.5	-1.4	-2.8	-2.2	-0.8	-0.4	-0.3	-0.2	-0.1	-0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.12.4 X2, End of Month Position

Revised Second Basis of Comparison

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	92.3	92.5	91.0	87.3	80.4	78.2	78.5	81.5	83.5	86.6	90.0	92.1
20%	91.8	91.3	90.6	85.9	75.6	73.5	75.2	79.6	81.6	84.8	88.5	91.4
30%	91.2	91.0	89.5	83.6	72.1	68.3	73.3	78.6	80.5	84.3	88.0	90.8
40%	91.0	90.8	88.7	78.9	66.2	66.6	69.7	75.4	78.6	82.1	86.5	90.1
50%	90.6	90.3	86.8	75.6	61.5	61.7	67.3	72.9	77.9	81.1	85.6	89.4
60%	90.2	89.6	82.5	67.7	55.7	57.8	64.2	70.3	76.1	78.9	84.7	89.0
70%	90.0	89.0	77.0	56.3	52.4	54.0	59.9	66.0	74.4	78.2	84.4	88.6
80%	89.6	88.0	65.9	51.9	49.4	50.4	54.7	60.2	71.4	77.3	84.1	88.4
90%	87.3	79.7	53.3	49.5	48.2	48.8	50.4	54.6	64.1	74.8	83.0	87.8
Long Term												
Full Simulation Period ^b	90.0	87.6	79.5	70.4	62.8	62.3	65.9	70.6	75.8	80.7	86.0	89.3
Water Year Types^c												
Wet (23%)	88.1	83.7	66.3	55.7	51.6	53.0	56.4	60.3	67.3	75.3	83.3	86.6
Above Normal (24%)	91.0	87.1	79.1	63.6	56.1	55.2	61.1	67.9	75.0	78.2	83.8	81.9
Below Normal (10%)	89.6	87.3	84.5	78.8	66.0	67.3	71.3	74.9	78.2	81.4	86.0	89.7
Dry (16%)	90.7	90.4	87.9	81.1	70.7	67.6	70.8	76.0	80.2	84.4	88.0	90.8
Critical (27%)	91.9	92.1	90.0	84.0	78.5	76.8	78.8	83.3	85.7	88.2	90.6	92.4

Alternative 5

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	93.2	93.3	90.8	84.0	77.3	75.9	77.2	79.1	83.1	86.5	89.6	91.9
20%	91.9	91.5	87.6	82.3	71.7	72.8	72.5	77.9	81.4	84.9	88.1	91.1
30%	91.6	91.0	83.9	79.8	67.2	65.8	69.5	75.8	81.0	84.2	87.4	90.5
40%	91.0	88.0	82.4	73.5	63.9	64.5	66.4	71.5	79.6	82.3	86.1	90.0
50%	89.5	81.1	81.2	71.2	58.5	59.9	64.2	69.3	77.8	80.7	84.8	88.5
60%	81.0	81.0	79.7	64.4	55.1	57.9	60.8	66.4	76.6	78.2	84.6	81.0
70%	74.1	75.1	71.9	55.1	51.9	53.9	58.0	63.7	73.4	77.5	84.1	74.1
80%	74.0	74.1	62.2	51.3	49.4	50.6	53.5	58.9	69.8	76.8	82.6	74.0
90%	74.0	73.9	53.0	49.4	48.2	49.1	49.9	53.3	63.5	74.6	82.2	74.0
Long Term												
Full Simulation Period ^b	84.2	82.3	76.4	68.0	61.1	61.4	63.8	68.2	75.7	80.4	85.3	83.8
Water Year Types^c												
Wet (23%)	80.6	76.9	63.7	54.7	51.2	53.1	55.1	58.2	67.3	74.7	82.6	73.9
Above Normal (24%)	86.8	82.1	74.9	60.9	54.9	55.3	59.0	65.0	75.2	77.9	83.1	74.8
Below Normal (10%)	80.4	80.3	80.4	74.6	64.3	66.9	68.4	72.1	79.0	81.1	85.0	89.3
Dry (16%)	85.6	85.5	84.5	77.7	67.7	65.4	67.9	73.4	79.8	84.5	87.6	90.5
Critical (27%)	90.4	90.6	88.2	82.1	75.5	74.6	76.7	80.8	84.5	87.7	90.2	92.1

Alternative 5 minus Revised Second Basis of Comparison

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.9	0.8	-0.1	-3.2	-3.1	-2.3	-1.4	-2.4	-0.4	-0.1	-0.4	-0.1
20%	0.1	0.1	-3.0	-3.6	-3.9	-0.7	-2.7	-1.6	-0.2	0.1	-0.4	-0.3
30%	0.4	0.0	-5.5	-3.8	-4.8	-2.5	-3.7	-2.7	0.4	-0.2	-0.6	-0.3
40%	0.0	-2.7	-6.3	-5.4	-2.2	-2.0	-3.3	-3.8	1.0	0.2	-0.5	0.0
50%	-1.0	-9.2	-5.6	-4.4	-3.0	-1.8	-3.1	-3.5	-0.2	-0.4	-0.8	-0.9
60%	-9.2	-8.6	-2.7	-3.3	-0.6	0.1	-3.4	-3.9	0.5	-0.8	-0.1	-8.0
70%	-15.9	-13.9	-5.2	-1.2	-0.5	-0.1	-1.9	-2.3	-1.0	-0.7	-0.3	-14.6
80%	-15.6	-13.9	-3.7	-0.6	0.0	0.2	-1.2	-1.3	-1.6	-0.5	-1.5	-14.4
90%	-13.4	-5.8	-0.3	-0.1	0.0	0.3	-0.5	-1.2	-0.7	-0.2	-0.8	-13.8
Long Term												
Full Simulation Period ^b	-5.7	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
Water Year Types^c												
Wet (23%)	-7.5	-6.8	-2.6	-1.0	-0.4	0.0	-1.3	-2.0	0.0	-0.5	-0.6	-12.7
Above Normal (24%)	-4.1	-5.0	-4.2	-2.7	-1.2	0.0	-2.1	-2.9	0.2	-0.3	-0.7	-7.2
Below Normal (10%)	-9.2	-7.0	-4.1	-4.2	-1.7	-0.5	-2.8	-2.8	0.7	-0.4	-1.0	-0.5
Dry (16%)	-5.1	-4.9	-3.4	-3.4	-3.1	-2.2	-2.9	-2.6	-0.4	0.1	-0.4	-0.3
Critical (27%)	-1.5	-1.4	-1.8	-1.9	-3.0	-2.1	-2.1	-2.5	-1.3	-0.5	-0.4	-0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

5C.3.2.13 Delta Outflow

Table 5C.3.2.13.1 Old and Middle River, Monthly Flow

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-3,764	-3,724	-3,812	-2,823	-666	-969	3,205	2,797	-1,150	-4,130	-2,453	-3,775
20%	-4,076	-4,560	-4,673	-2,823	-1,771	-1,394	2,207	1,304	-1,570	-6,849	-4,032	-5,147
30%	-4,613	-5,156	-5,244	-3,355	-2,823	-2,738	1,632	561	-3,500	-7,647	-5,770	-6,006
40%	-4,820	-5,627	-5,871	-4,392	-3,314	-3,500	1,268	108	-3,500	-8,888	-7,996	-7,621
50%	-5,328	-6,320	-5,871	-4,710	-3,781	-3,500	612	-182	-3,500	-9,376	-9,956	-9,000
60%	-5,589	-6,564	-5,871	-5,000	-4,878	-4,568	-102	-483	-4,487	-9,746	-10,630	-9,256
70%	-6,253	-7,101	-7,413	-5,000	-5,000	-5,000	-448	-632	-5,000	-10,301	-10,737	-9,653
80%	-6,560	-8,185	-9,537	-5,000	-5,000	-5,000	-995	-1,129	-5,000	-10,602	-10,853	-9,884
90%	-7,404	-9,995	-9,681	-5,000	-5,000	-5,000	-1,247	-1,414	-5,000	-11,108	-11,083	-10,032
Long Term												
Full Simulation Period ^b	-5,476	-6,380	-6,228	-3,535	-2,905	-2,690	919	310	-3,577	-8,496	-7,975	-7,706
Water Year Types^c												
Wet (23%)	-5,847	-7,229	-5,526	-1,900	-1,991	-1,552	3,110	2,011	-4,274	-8,957	-10,532	-9,358
Above Normal (24%)	-5,525	-6,801	-6,850	-3,699	-3,161	-4,176	1,196	412	-4,525	-9,151	-10,873	-9,542
Below Normal (10%)	-5,488	-6,749	-7,669	-4,380	-3,477	-3,919	165	-316	-3,445	-10,539	-9,624	-8,178
Dry (16%)	-5,440	-5,953	-6,676	-4,621	-3,573	-3,072	-670	-906	-3,350	-8,900	-4,745	-6,453
Critical (27%)	-4,671	-4,458	-5,006	-4,314	-2,968	-1,780	-786	-887	-1,539	-4,242	-3,168	-3,793

Revised Alternative 1

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-3,213	-4,272	-3,968	-2,854	-824	-160	-2,064	-1,634	-2,112	-3,246	-3,105	-3,732
20%	-3,760	-5,330	-6,081	-4,745	-2,550	-1,248	-3,157	-2,833	-2,809	-5,223	-4,480	-5,069
30%	-4,915	-6,950	-6,787	-6,261	-4,041	-3,273	-4,168	-3,932	-3,314	-6,217	-5,712	-6,231
40%	-6,258	-7,438	-7,871	-7,379	-5,843	-4,024	-4,920	-4,714	-3,970	-7,181	-7,103	-8,305
50%	-7,278	-8,669	-8,406	-8,289	-6,429	-4,945	-5,965	-5,153	-5,163	-8,021	-8,109	-9,168
60%	-8,071	-9,221	-9,004	-8,845	-7,331	-5,427	-6,654	-5,526	-5,795	-8,941	-9,175	-9,647
70%	-9,158	-9,706	-9,347	-9,257	-8,356	-6,217	-7,180	-5,865	-6,068	-9,445	-9,861	-9,963
80%	-9,924	-9,988	-9,503	-9,553	-8,878	-6,633	-7,672	-6,382	-6,578	-9,955	-10,366	-10,089
90%	-10,188	-10,067	-9,686	-9,795	-9,516	-7,604	-8,033	-7,291	-7,016	-10,733	-10,684	-10,164
Long Term												
Full Simulation Period ^b	-6,927	-7,828	-7,459	-6,669	-4,977	-3,763	-5,451	-4,776	-4,655	-7,520	-7,457	-7,883
Water Year Types^c												
Wet (23%)	-7,970	-9,125	-7,749	-4,991	-2,581	-1,121	-7,036	-6,345	-4,153	-8,364	-9,546	-9,646
Above Normal (24%)	-6,298	-7,886	-7,998	-8,337	-6,176	-5,288	-7,062	-5,723	-5,991	-8,950	-9,951	-9,844
Below Normal (10%)	-8,002	-8,896	-8,199	-8,551	-5,299	-5,515	-5,435	-4,867	-6,643	-10,133	-8,149	-8,185
Dry (16%)	-6,476	-7,093	-7,256	-7,215	-6,840	-5,661	-4,200	-3,734	-4,589	-6,796	-5,151	-6,536
Critical (27%)	-5,117	-5,206	-5,908	-5,862	-5,471	-3,067	-2,373	-2,005	-2,584	-2,950	-3,436	-3,906

Revised Alternative 1 minus No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	552	-548	-156	-32	-158	809	-5270	-4431	-961	883	-652	43
20%	317	-770	-1409	-1922	-779	146	-5363	-4137	-1239	1626	-448	78
30%	-302	-1794	-1543	-2906	-1218	-535	-5800	-4493	186	1429	57	-226
40%	-1437	-1812	-2000	-2986	-2529	-524	-6188	-4822	-470	1707	893	-684
50%	-1950	-2349	-2535	-3579	-2648	-1445	-6576	-4971	-1663	1355	1847	-168
60%	-2482	-2657	-3133	-3845	-2453	-860	-6552	-5043	-1309	805	1455	-391
70%	-2905	-2605	-1934	-4257	-3356	-1217	-6732	-5233	-1068	856	876	-311
80%	-3363	-1803	34	-4553	-3878	-1633	-6677	-5253	-1578	647	488	-205
90%	-2784	-71	-5	-4795	-4516	-2604	-6786	-5876	-2016	375	399	-133
Long Term												
Full Simulation Period ^b	-1451	-1448	-1232	-3134	-2072	-1073	-6371	-5086	-1078	976	518	-177
Water Year Types^c												
Wet (23%)	-2123	-1895	-2223	-3091	-590	432	-10146	-8356	121	593	986	-288
Above Normal (24%)	-773	-1085	-1148	-4637	-3015	-1112	-8258	-6134	-1466	200	922	-302
Below Normal (10%)	-2514	-2147	-530	-4171	-1823	-1597	-5601	-4551	-3198	407	1476	-7
Dry (16%)	-1036	-1140	-581	-2594	-3267	-2588	-3531	-2828	-1240	2104	-406	-84
Critical (27%)	-446	-748	-902	-1548	-2503	-1287	-1587	-1118	-1045	1291	-268	-113

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

5C.3.2.14 Exports through Jones and Banks Pumping Plants

Table 5C.3.2.14.1 Exports Through Jones and Banks Pumping Plants, Monthly Export Volume

No Action Alternative

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	517	671	721	604	611	675	242	240	509	714	724	671
20%	454	572	717	490	532	617	181	151	359	708	724	664
30%	434	479	685	427	448	508	158	127	340	694	715	651
40%	400	443	558	419	409	479	138	104	318	667	707	623
50%	370	415	494	406	380	424	128	97	253	634	692	604
60%	336	381	477	396	363	349	121	92	207	588	519	509
70%	310	347	454	377	325	312	113	92	192	501	371	410
80%	286	302	379	321	267	283	104	92	150	444	240	335
90%	250	251	335	280	165	159	89	92	43	232	141	243
Long Term												
Full Simulation Period ^b	378	430	527	426	395	423	154	140	276	558	521	514
Water Year Types^c												
Wet (23%)	410	497	564	513	537	594	204	207	445	669	717	638
Above Normal (24%)	376	450	562	406	401	496	130	105	315	587	709	628
Below Normal (10%)	386	456	590	387	354	394	134	100	209	657	622	542
Dry (16%)	374	398	510	392	315	318	153	126	194	541	296	426
Critical (27%)	314	293	384	349	250	179	93	90	64	223	176	242

Revised Alternative 1

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	694	671	738	803	722	707	530	515	526	694	694	671
20%	681	671	723	769	684	619	508	417	450	694	694	671
30%	626	659	719	746	666	563	481	369	429	691	694	671
40%	551	622	717	738	602	542	433	351	408	609	621	668
50%	488	590	683	724	552	512	391	314	392	555	529	628
60%	426	502	609	645	512	489	336	277	353	474	468	549
70%	327	460	554	562	461	459	264	228	316	390	364	408
80%	249	349	492	499	393	373	189	169	176	306	281	338
90%	196	286	382	371	309	301	109	81	128	146	183	228
Long Term												
Full Simulation Period ^b	467	524	613	638	528	491	355	302	349	494	487	526
Water Year Types^c												
Wet (23%)	544	620	717	724	587	554	485	428	451	632	653	660
Above Normal (24%)	419	520	641	719	590	568	455	359	411	574	647	648
Below Normal (10%)	544	595	629	670	471	498	342	296	413	631	525	543
Dry (16%)	434	472	550	567	516	491	262	221	273	401	323	431
Critical (27%)	336	340	444	451	405	264	135	110	132	138	195	249

Revised Alternative 1 minus No Action Alternative

Statistic	Monthly Export Volume (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	34%	0%	2%	33%	18%	5%	119%	115%	3%	-3%	-4%	0%
20%	50%	17%	1%	57%	29%	0%	180%	176%	25%	-2%	-4%	1%
30%	44%	38%	5%	75%	49%	11%	205%	189%	26%	0%	-3%	3%
40%	38%	40%	28%	76%	47%	13%	214%	238%	28%	-9%	-12%	7%
50%	32%	42%	38%	79%	45%	21%	205%	225%	55%	-12%	-24%	4%
60%	27%	32%	28%	63%	41%	40%	179%	201%	70%	-19%	-10%	8%
70%	5%	33%	22%	49%	42%	47%	133%	147%	64%	-22%	-2%	0%
80%	-13%	16%	30%	55%	48%	32%	82%	83%	17%	-31%	17%	1%
90%	-22%	14%	14%	33%	88%	89%	22%	-12%	200%	-37%	30%	-6%
Long Term												
Full Simulation Period ^b	23%	22%	16%	50%	34%	16%	130%	117%	27%	-11%	-6%	2%
Water Year Types^c												
Wet (23%)	33%	25%	27%	41%	9%	-7%	138%	107%	1%	-5%	-9%	3%
Above Normal (24%)	11%	16%	14%	77%	47%	14%	249%	241%	30%	-2%	-9%	3%
Below Normal (10%)	41%	30%	7%	73%	33%	27%	154%	196%	98%	-4%	-16%	0%
Dry (16%)	16%	19%	8%	45%	64%	55%	71%	76%	41%	-26%	9%	1%
Critical (27%)	7%	16%	16%	29%	62%	47%	46%	23%	105%	-38%	11%	3%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.14.2 Exports Through Jones and Banks Pumping Plants, Monthly Export Volume

Revised Second Basis of Comparison

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	694	671	738	803	722	707	530	515	526	694	694	671
20%	681	671	723	769	684	619	508	417	450	694	694	671
30%	626	659	719	746	666	563	481	369	429	691	694	671
40%	551	622	717	738	602	542	433	351	408	609	621	668
50%	488	590	683	724	552	512	391	314	392	555	529	628
60%	426	502	609	645	512	489	336	277	353	474	468	549
70%	327	460	554	562	461	459	264	228	316	390	364	408
80%	249	349	492	499	393	373	189	169	176	306	281	338
90%	196	286	382	371	309	301	109	81	128	146	183	228
Long Term												
Full Simulation Period ^b	467	524	613	638	528	491	355	302	349	494	487	526
Water Year Types^c												
Wet (23%)	544	620	717	724	587	554	485	428	451	632	653	660
Above Normal (24%)	419	520	641	719	590	568	455	359	411	574	647	648
Below Normal (10%)	544	595	629	670	471	498	342	296	413	631	525	543
Dry (16%)	434	472	550	567	516	491	262	221	273	401	323	431
Critical (27%)	336	340	444	451	405	264	135	110	132	138	195	249

No Action Alternative

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	517	671	721	604	611	675	242	240	509	714	724	671
20%	454	572	717	490	532	617	181	151	359	708	724	664
30%	434	479	685	427	448	508	158	127	340	694	715	651
40%	400	443	558	419	409	479	138	104	318	667	707	623
50%	370	415	494	406	380	424	128	97	253	634	692	604
60%	336	381	477	396	363	349	121	92	207	588	519	509
70%	310	347	454	377	325	312	113	92	192	501	371	410
80%	286	302	379	321	267	283	104	92	150	444	240	335
90%	250	251	335	280	165	159	89	92	43	232	141	243
Long Term												
Full Simulation Period ^b	378	430	527	426	395	423	154	140	276	558	521	514
Water Year Types^c												
Wet (23%)	410	497	564	513	537	594	204	207	445	669	717	638
Above Normal (24%)	376	450	562	406	401	496	130	105	315	587	709	628
Below Normal (10%)	386	456	590	387	354	394	134	100	209	657	622	542
Dry (16%)	374	398	510	392	315	318	153	126	194	541	296	426
Critical (27%)	314	293	384	349	250	179	93	90	64	223	176	242

No Action Alternative minus Revised Second Basis of Comparison

Statistic	Monthly Export Volume (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-25%	0%	-2%	-25%	-15%	-5%	-54%	-53%	-3%	3%	4%	0%
20%	-33%	-15%	-1%	-36%	-22%	0%	-64%	-64%	-20%	2%	4%	-1%
30%	-31%	-27%	-5%	-43%	-33%	-10%	-67%	-65%	-21%	0%	3%	-3%
40%	-27%	-29%	-22%	-43%	-32%	-12%	-68%	-70%	-22%	9%	14%	-7%
50%	-24%	-30%	-28%	-44%	-31%	-17%	-67%	-69%	-36%	14%	31%	-4%
60%	-21%	-24%	-22%	-39%	-29%	-29%	-64%	-67%	-41%	24%	11%	-7%
70%	-5%	-25%	-18%	-33%	-30%	-32%	-57%	-60%	-39%	29%	2%	0%
80%	15%	-14%	-23%	-36%	-32%	-24%	-45%	-45%	-14%	45%	-14%	-1%
90%	28%	-12%	-12%	-25%	-47%	-47%	-18%	14%	-67%	58%	-23%	7%
Long Term												
Full Simulation Period ^b	-19%	-18%	-14%	-33%	-25%	-14%	-57%	-54%	-21%	13%	7%	-2%
Water Year Types^c												
Wet (23%)	-25%	-20%	-21%	-29%	-8%	7%	-58%	-52%	-1%	6%	10%	-3%
Above Normal (24%)	-10%	-13%	-12%	-44%	-32%	-13%	-71%	-71%	-23%	2%	9%	-3%
Below Normal (10%)	-29%	-23%	-6%	-42%	-25%	-21%	-61%	-66%	-49%	4%	19%	0%
Dry (16%)	-14%	-16%	-7%	-31%	-39%	-35%	-41%	-43%	-29%	35%	-8%	-1%
Critical (27%)	-6%	-14%	-14%	-23%	-38%	-32%	-31%	-18%	-51%	62%	-10%	-3%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.14.3 Exports Through Jones and Banks Pumping Plants, Monthly Export Volume

Revised Second Basis of Comparison

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	694	671	738	803	722	707	530	515	526	694	694	671
20%	681	671	723	769	684	619	508	417	450	694	694	671
30%	626	659	719	746	666	563	481	369	429	691	694	671
40%	551	622	717	738	602	542	433	351	408	609	621	668
50%	488	590	683	724	552	512	391	314	392	555	529	628
60%	426	502	609	645	512	489	336	277	353	474	468	549
70%	327	460	554	562	461	459	264	228	316	390	364	408
80%	249	349	492	499	393	373	189	169	176	306	281	338
90%	196	286	382	371	309	301	109	81	128	146	183	228
Long Term												
Full Simulation Period ^b	467	524	613	638	528	491	355	302	349	494	487	526
Water Year Types^c												
Wet (23%)	544	620	717	724	587	554	485	428	451	632	653	660
Above Normal (24%)	419	520	641	719	590	568	455	359	411	574	647	648
Below Normal (10%)	544	595	629	670	471	498	342	296	413	631	525	543
Dry (16%)	434	472	550	567	516	491	262	221	273	401	323	431
Critical (27%)	336	340	444	451	405	264	135	110	132	138	195	249

Alternative 3

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	694	671	718	653	725	722	547	563	667	694	694	671
20%	673	671	691	565	603	622	510	496	461	694	694	671
30%	627	652	628	440	524	577	465	452	399	694	694	671
40%	552	627	583	422	449	532	437	386	373	680	694	657
50%	476	571	546	411	393	460	369	329	355	628	624	640
60%	382	501	523	395	365	351	320	281	338	566	502	572
70%	322	467	505	377	320	316	255	230	311	448	396	417
80%	265	346	479	328	264	288	187	124	252	382	268	344
90%	218	276	378	304	202	159	124	102	138	190	170	228
Long Term												
Full Simulation Period ^b	465	520	549	442	426	445	353	330	362	533	513	529
Water Year Types^c												
Wet (23%)	544	615	601	559	594	589	494	490	519	648	667	654
Above Normal (24%)	430	533	574	414	469	566	441	413	397	586	680	647
Below Normal (10%)	524	587	607	394	373	448	312	266	330	683	650	588
Dry (16%)	440	471	523	389	314	337	270	242	292	492	318	426
Critical (27%)	321	319	401	355	251	180	127	100	131	158	196	245

Alternative 3 minus Revised Second Basis of Comparison

Statistic	Monthly Export Volume (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	-3%	-19%	0%	2%	3%	9%	27%	0%	0%	0%
20%	-1%	0%	-4%	-26%	-12%	1%	0%	19%	2%	0%	0%	0%
30%	0%	-1%	-13%	-41%	-21%	2%	-3%	22%	-7%	0%	0%	0%
40%	0%	1%	-19%	-43%	-25%	-2%	1%	10%	-9%	12%	12%	-2%
50%	-3%	-3%	-20%	-43%	-29%	-10%	-6%	5%	-9%	13%	18%	2%
60%	-10%	0%	-14%	-39%	-29%	-28%	-5%	1%	-4%	20%	7%	4%
70%	-2%	1%	-9%	-33%	-31%	-31%	-3%	1%	-1%	15%	9%	2%
80%	7%	-1%	-3%	-34%	-33%	-23%	-1%	-26%	43%	25%	-5%	2%
90%	11%	-3%	-1%	-18%	-35%	-47%	14%	25%	7%	30%	-7%	0%
Long Term												
Full Simulation Period ^b	0%	-1%	-10%	-31%	-19%	-9%	-1%	9%	4%	8%	5%	0%
Water Year Types^c												
Wet (23%)	0%	-1%	-16%	-23%	1%	6%	2%	14%	15%	2%	2%	-1%
Above Normal (24%)	3%	2%	-10%	-42%	-21%	0%	-3%	15%	-3%	2%	5%	0%
Below Normal (10%)	-4%	-1%	-3%	-41%	-21%	-10%	-9%	-10%	-20%	8%	24%	8%
Dry (16%)	1%	0%	-5%	-31%	-39%	-31%	3%	9%	7%	23%	-1%	-1%
Critical (27%)	-4%	-6%	-10%	-21%	-38%	-32%	-6%	-9%	0%	15%	0%	-2%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.14.4 Exports Through Jones and Banks Pumping Plants, Monthly Export Volume

Revised Second Basis of Comparison

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	694	671	738	803	722	707	530	515	526	694	694	671
20%	681	671	723	769	684	619	508	417	450	694	694	671
30%	626	659	719	746	666	563	481	369	429	691	694	671
40%	551	622	717	738	602	542	433	351	408	609	621	668
50%	488	590	683	724	552	512	391	314	392	555	529	628
60%	426	502	609	645	512	489	336	277	353	474	468	549
70%	327	460	554	562	461	459	264	228	316	390	364	408
80%	249	349	492	499	393	373	189	169	176	306	281	338
90%	196	286	382	371	309	301	109	81	128	146	183	228
Long Term												
Full Simulation Period ^b	467	524	613	638	528	491	355	302	349	494	487	526
Water Year Types^c												
Wet (23%)	544	620	717	724	587	554	485	428	451	632	653	660
Above Normal (24%)	419	520	641	719	590	568	455	359	411	574	647	648
Below Normal (10%)	544	595	629	670	471	498	342	296	413	631	525	543
Dry (16%)	434	472	550	567	516	491	262	221	273	401	323	431
Critical (27%)	336	340	444	451	405	264	135	110	132	138	195	249

Alternative 5

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	514	671	721	604	613	677	223	218	509	714	724	671
20%	454	553	717	490	528	612	165	127	359	709	724	662
30%	429	479	685	427	448	528	134	91	340	696	715	648
40%	378	443	558	419	416	479	122	83	318	678	705	626
50%	360	408	496	405	380	424	111	71	251	646	693	598
60%	334	375	481	396	363	349	97	50	207	606	571	508
70%	311	347	452	377	323	312	80	38	193	568	401	415
80%	289	302	387	319	267	283	45	23	178	445	278	347
90%	245	250	337	280	165	159	30	7	42	271	192	254
Long Term												
Full Simulation Period ^b	376	427	528	427	394	423	122	99	279	570	538	514
Water Year Types^c												
Wet (23%)	408	505	564	514	532	592	202	202	444	667	718	627
Above Normal (24%)	376	423	561	407	405	496	127	92	315	590	705	625
Below Normal (10%)	381	456	588	387	359	397	103	55	208	663	632	561
Dry (16%)	370	394	513	392	315	318	80	41	205	577	333	433
Critical (27%)	313	293	382	355	249	179	34	20	69	239	222	243

Alternative 5 minus Revised Second Basis of Comparison

Statistic	Monthly Export Volume (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-26%	0%	-2%	-25%	-15%	-4%	-58%	-58%	-3%	3%	4%	0%
20%	-33%	-18%	-1%	-36%	-23%	-1%	-67%	-70%	-20%	2%	4%	-1%
30%	-32%	-27%	-5%	-43%	-33%	-6%	-72%	-75%	-21%	1%	3%	-4%
40%	-31%	-29%	-22%	-43%	-31%	-12%	-72%	-77%	-22%	11%	14%	-6%
50%	-26%	-31%	-27%	-44%	-31%	-17%	-72%	-77%	-36%	16%	31%	-5%
60%	-22%	-25%	-21%	-39%	-29%	-29%	-71%	-82%	-41%	28%	22%	-8%
70%	-5%	-25%	-18%	-33%	-30%	-32%	-70%	-84%	-39%	46%	10%	2%
80%	16%	-14%	-21%	-36%	-32%	-24%	-76%	-86%	1%	45%	-1%	3%
90%	25%	-13%	-12%	-25%	-47%	-47%	-72%	-91%	-67%	85%	5%	11%
Long Term												
Full Simulation Period ^b	-19%	-18%	-14%	-33%	-25%	-14%	-66%	-67%	-20%	15%	10%	-2%
Water Year Types^c												
Wet (23%)	-25%	-19%	-21%	-29%	-9%	7%	-58%	-53%	-1%	6%	10%	-5%
Above Normal (24%)	-10%	-19%	-12%	-43%	-31%	-13%	-72%	-74%	-23%	3%	9%	-4%
Below Normal (10%)	-30%	-23%	-6%	-42%	-24%	-20%	-70%	-82%	-50%	5%	21%	3%
Dry (16%)	-15%	-16%	-7%	-31%	-39%	-35%	-69%	-81%	-25%	44%	3%	0%
Critical (27%)	-7%	-14%	-14%	-21%	-38%	-32%	-75%	-82%	-48%	74%	14%	-2%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

5C.3.2.15 CVP Deliveries

Table 5C.3.2.15.1.1 CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP Deliveries

				Revised Alternative 1	No Action Alternative	Revised Alternative 1 minus No Action Alternative
Water Supply Reliability						
Sacramento River Hydrologic Region						
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term	1,858	1,859	-1
			Dry	1,905	1,906	-1
			Critical	1,732	1,737	-5
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	155	146	8
			Dry	151	146	5
			Critical	105	102	3
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	214	207	7
			Dry	192	186	5
			Critical	151	152	-1
CVP Ag	Contract Delivery (annual average - does not include Settlement contractors)	(TAF/year)	Long Term	219	185	34
			Dry	122	86	37
			Critical	35	24	12
San Joaquin River Hydrologic Region (not including Friant-Kern and Madera Canal water users and Eastside Contractors deliveries)						
CVP Exchange	Contract Delivery (annual average)	(TAF/year)	Long Term	852	852	0
			Dry	875	875	0
			Critical	741	741	0
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	260	261	0
			Dry	268	269	-1
			Critical	221	224	-3
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	0	0	0
			Dry	0	0	0
			Critical	0	0	0
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	348	269	79
			Dry	203	140	63
			Critical	61	41	20
San Francisco Bay Hydrologic Region						
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	288	275	13
			Dry	284	274	10
			Critical	269	264	4
CVP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	43	33	11
			Dry	25	17	8
			Critical	7	5	2
Central Coast Hydrologic Region						
Tulare Lake Hydrologic Region (not including Friant-Kern Canal water users)						
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	12	12	0
			Dry	12	12	0
			Critical	10	10	0
CVP Ag	Contract Delivery (annual average - includes Cross Valley Canal)	(TAF/year)	Long Term	709	545	164
			Dry	422	288	134
			Critical	127	85	41
Total For All Regions						
Total Supplies	Contract Delivery (annual average)	(TAF/year)	Long Term	4,959	4,646	313
			Dry	4,459	4,198	261
			Critical	3,460	3,385	74

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text. 6) Annual deliveries are based on March to February Average.

Table 5C.3.2.15.1.2 CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP Deliveries

				Revised Alternative 1	No Action Alternative	Revised Alternative 1 minus No Action Alternative
Water Supply Reliability						
North of Delta						
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term Dry Critical	219 122 35	185 86 24	34 37 12
CVP M&I (Including American River)	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	485 461 408	467 447 405	18 14 3
CVP M&I American River	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	120 105 79	113 97 75	7 8 5
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	1,858 1,905 1,732	1,859 1,906 1,737	-1 -1 -5
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	155 151 105	146 146 102	8 5 3
Total CVP North of Delta						
Total CVP Ag, M&I, Settlement, and Refuge Deliveries	Contract Delivery (CVP) (annual average)	(TAF/year)	Long Term Dry Critical	2,717 2,639 2,281	2,658 2,584 2,268	59 55 13
South of Delta (Does not include Eastside Contractors deliveries)						
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term Dry Critical	1,100 650 195	847 445 131	253 206 64
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	17 15 12	15 14 11	2 1 1
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	260 268 221	261 269 224	0 -1 -3
Total CVP South of Delta (Does not include Eastside Contractors deliveries)						
Total CVP Ag, M&I, Settlement, and Refuge Deliveries	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	1,377 933 428	1,123 727 366	254 206 62
Eastside Contractors deliveries						
Water Rights	Delivery (annual average)	(TAF/year)	Long Term Dry Critical	514 524 486	508 524 445	6 0 42
CVP Service Contracts	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	118 98 25	104 84 4	15 13 21
Total Eastside Contractors Deliveries						
Total Water Rights and CVP Service Contracts Deliveries	Delivery (annual average)	(TAF/year)	Long Term Dry Critical	632 621 511	611 608 449	21 13 63

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text. 6) Annual deliveries are based on March to February Average.

Table 5C.3.2.15.2.1 CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP Deliveries

				No Action Alternative	Revised Second Basis of Comparison	No Action Alternative minus Revised Second Basis of Comparison
Water Supply Reliability						
Sacramento River Hydrologic Region						
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term	1,859	1,858	1
			Dry	1,906	1,905	1
			Critical	1,737	1,732	5
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	146	155	-8
			Dry	146	151	-5
			Critical	102	105	-3
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	207	214	-7
			Dry	186	192	-5
			Critical	152	151	1
CVP Ag	Contract Delivery (annual average - does not include Settlement contractors)	(TAF/year)	Long Term	185	219	-34
			Dry	86	122	-37
			Critical	24	35	-12
San Joaquin River Hydrologic Region (not including Friant-Kern and Madera Canal water users and Eastside Contractors deliveries)						
CVP Exchange	Contract Delivery (annual average)	(TAF/year)	Long Term	852	852	0
			Dry	875	875	0
			Critical	741	741	0
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	261	260	0
			Dry	269	268	1
			Critical	224	221	3
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	0	0	0
			Dry	0	0	0
			Critical	0	0	0
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	269	348	-79
			Dry	140	203	-63
			Critical	41	61	-20
San Francisco Bay Hydrologic Region						
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	275	288	-13
			Dry	274	284	-10
			Critical	264	269	-4
CVP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	33	43	-11
			Dry	17	25	-8
			Critical	5	7	-2
Central Coast Hydrologic Region						
Tulare Lake Hydrologic Region (not including Friant-Kern Canal water users)						
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	12	12	0
			Dry	12	12	0
			Critical	10	10	0
CVP Ag	Contract Delivery (annual average - includes Cross Valley Canal)	(TAF/year)	Long Term	545	709	-164
			Dry	288	422	-134
			Critical	85	127	-41
Total For All Regions						
Total Supplies	Contract Delivery (annual average)	(TAF/year)	Long Term	4,646	4,959	-313
			Dry	4,198	4,459	-261
			Critical	3,385	3,460	-74

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text. 6) Annual deliveries are based on March to February Average.

Table 5C.3.2.15.2.2 CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP Deliveries

				No Action Alternative	Revised Second Basis of Comparison	No Action Alternative minus Revised Second Basis of Comparison
Water Supply Reliability						
North of Delta						
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term Dry Critical	185 86 24	219 122 35	-34 -37 -12
CVP M&I (Including American River)	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	467 447 405	485 461 408	-18 -14 -3
CVP M&I American River	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	113 97 75	120 105 79	-7 -8 -5
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	1,859 1,906 1,737	1,858 1,905 1,732	1 1 5
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	146 146 102	155 151 105	-8 -5 -3
Total CVP North of Delta						
Total CVP Ag, M&I, Settlement, and Refuge Deliveries	Contract Delivery (CVP) (annual average)	(TAF/year)	Long Term Dry Critical	2,658 2,584 2,268	2,717 2,639 2,281	-59 -55 -13
South of Delta (Does not include Eastside Contractors deliveries)						
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term Dry Critical	847 445 131	1,100 650 195	-253 -206 -64
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	15 14 11	17 15 12	-2 -1 -1
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	261 269 224	260 268 221	0 1 3
Total CVP South of Delta (Does not include Eastside Contractors deliveries)						
Total CVP Ag, M&I, Settlement, and Refuge Deliveries	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	1,123 727 366	1,377 933 428	-254 -206 -62
Eastside Contractors deliveries						
Water Rights	Delivery (annual average)	(TAF/year)	Long Term Dry Critical	508 524 445	514 524 486	-6 0 -42
CVP Service Contracts	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	104 84 4	118 98 25	-15 -13 -21
Total Eastside Contractors Deliveries						
Total Water Rights and CVP Service Contracts Deliveries	Delivery (annual average)	(TAF/year)	Long Term Dry Critical	611 608 449	632 621 511	-21 -13 -63

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text. 6) Annual deliveries are based on March to February Average.

Table 5C.3.2.15.3.1 CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP Deliveries

				Alternative 3	Revised Second Basis of Comparison	Alternative 3 minus Revised Second Basis of Comparison
Water Supply Reliability						
Sacramento River Hydrologic Region						
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term	1,860	1,858	2
			Dry	1,906	1,905	1
			Critical	1,742	1,732	10
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	153	155	-1
			Dry	149	151	-2
			Critical	103	105	-2
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	214	214	0
			Dry	192	192	0
			Critical	152	151	2
CVP Ag	Contract Delivery (annual average - does not include Settlement contractors)	(TAF/year)	Long Term	209	219	-10
			Dry	111	122	-11
			Critical	31	35	-4
San Joaquin River Hydrologic Region (not including Friant-Kern and Madera Canal water users and Eastside Contractors deliveries)						
CVP Exchange	Contract Delivery (annual average)	(TAF/year)	Long Term	852	852	0
			Dry	875	875	0
			Critical	741	741	0
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	261	260	1
			Dry	269	268	1
			Critical	224	221	3
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	0	0	0
			Dry	0	0	0
			Critical	0	0	0
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	342	348	-6
			Dry	185	203	-17
			Critical	53	61	-8
San Francisco Bay Hydrologic Region						
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	286	288	-2
			Dry	283	284	-1
			Critical	267	269	-2
CVP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	42	43	-1
			Dry	23	25	-2
			Critical	6	7	-1
Central Coast Hydrologic Region						
Tulare Lake Hydrologic Region (not including Friant-Kern Canal water users)						
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	12	12	0
			Dry	12	12	0
			Critical	10	10	0
CVP Ag	Contract Delivery (annual average - includes Cross Valley Canal)	(TAF/year)	Long Term	696	709	-13
			Dry	387	422	-35
			Critical	108	127	-18
Total For All Regions						
Total Supplies	Contract Delivery (annual average)	(TAF/year)	Long Term	4,927	4,959	-32
			Dry	4,392	4,459	-67
			Critical	3,437	3,460	-22

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text. 6) Annual deliveries are based on March to February Average.

Table 5C.3.2.15.3.2 CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP Deliveries

				Alternative 3	Revised Second Basis of Comparison	Alternative 3 minus Revised Second Basis of Comparison
Water Supply Reliability						
North of Delta						
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term Dry Critical	209 111 31	219 122 35	-10 -11 -4
CVP M&I (Including American River)	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	483 460 408	485 461 408	-2 -1 0
CVP M&I American River	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	118 104 78	120 105 79	-2 -1 -2
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	1,860 1,906 1,742	1,858 1,905 1,732	2 1 10
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	153 149 103	155 151 105	-1 -2 -2
Total CVP North of Delta						
Total CVP Ag, M&I, Settlement, and Refuge Deliveries	Contract Delivery (CVP) (annual average)	(TAF/year)	Long Term Dry Critical	2,706 2,626 2,284	2,717 2,639 2,281	-11 -13 3
South of Delta (Does not include Eastside Contractors deliveries)						
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term Dry Critical	1,079 596 168	1,100 650 195	-20 -55 -28
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	17 15 11	17 15 12	0 0 0
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	261 269 224	260 268 221	1 1 3
Total CVP South of Delta (Does not include Eastside Contractors deliveries)						
Total CVP Ag, M&I, Settlement, and Refuge Deliveries	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	1,357 879 403	1,377 933 428	-20 -54 -25
Eastside Contractors deliveries						
Water Rights	Delivery (annual average)	(TAF/year)	Long Term Dry Critical	513 524 478	514 524 486	-1 0 -8
CVP Service Contracts	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	123 109 36	118 98 25	5 12 11
Total Eastside Contractors Deliveries						
Total Water Rights and CVP Service Contracts Deliveries	Delivery (annual average)	(TAF/year)	Long Term Dry Critical	636 633 514	632 621 511	4 12 3

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text. 6) Annual deliveries are based on March to February Average.

Table 5C.3.2.15.4.1 CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP Deliveries

				Alternative 5	Revised Second Basis of Comparison	Alternative 5 minus Revised Second Basis of Comparison
Water Supply Reliability						
Sacramento River Hydrologic Region						
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term	1,861	1,858	3
			Dry	1,906	1,905	1
			Critical	1,747	1,732	15
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	146	155	-8
			Dry	145	151	-6
			Critical	103	105	-2
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	207	214	-6
			Dry	186	192	-6
			Critical	152	151	1
CVP Ag	Contract Delivery (annual average - does not include Settlement contractors)	(TAF/year)	Long Term	185	219	-34
			Dry	85	122	-37
			Critical	24	35	-11
San Joaquin River Hydrologic Region (not including Friant-Kern and Madera Canal water users and Eastside Contractors deliveries)						
CVP Exchange	Contract Delivery (annual average)	(TAF/year)	Long Term	852	852	0
			Dry	875	875	0
			Critical	741	741	0
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	261	260	0
			Dry	269	268	1
			Critical	222	221	0
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	0	0	0
			Dry	0	0	0
			Critical	0	0	0
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	264	348	-84
			Dry	135	203	-68
			Critical	40	61	-21
San Francisco Bay Hydrologic Region						
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	275	288	-13
			Dry	275	284	-9
			Critical	264	269	-5
CVP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	32	43	-11
			Dry	17	25	-8
			Critical	5	7	-2
Central Coast Hydrologic Region						
Tulare Lake Hydrologic Region (not including Friant-Kern Canal water users)						
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	12	12	0
			Dry	12	12	0
			Critical	10	10	0
CVP Ag	Contract Delivery (annual average - includes Cross Valley Canal)	(TAF/year)	Long Term	538	709	-171
			Dry	281	422	-141
			Critical	85	127	-42
Total For All Regions						
Total Supplies	Contract Delivery (annual average)	(TAF/year)	Long Term	4,634	4,959	-324
			Dry	4,186	4,459	-273
			Critical	3,393	3,460	-67

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text. 6) Annual deliveries are based on March to February Average.

Table 5C.3.2.15.4.2 CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP Deliveries

				Alternative 5	Revised Second Basis of Comparison	Alternative 5 minus Revised Second Basis of Comparison
Water Supply Reliability						
North of Delta						
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term Dry Critical	185 85 24	219 122 35	-34 -37 -11
CVP M&I (Including American River)	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	467 447 405	485 461 408	-18 -14 -3
CVP M&I American River	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	112 96 74	120 105 79	-7 -9 -6
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	1,861 1,906 1,747	1,858 1,905 1,732	3 1 15
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	146 145 103	155 151 105	-8 -6 -2
Total CVP North of Delta						
Total CVP Ag, M&I, Settlement, and Refuge Deliveries	Contract Delivery (CVP) (annual average)	(TAF/year)	Long Term Dry Critical	2,660 2,584 2,279	2,717 2,639 2,281	-57 -55 -2
South of Delta (Does not include Eastside Contractors deliveries)						
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term Dry Critical	834 433 130	1,100 650 195	-266 -217 -65
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	15 14 11	17 15 12	-2 -1 -1
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	261 269 222	260 268 221	0 1 0
Total CVP South of Delta (Does not include Eastside Contractors deliveries)						
Total CVP Ag, M&I, Settlement, and Refuge Deliveries	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	1,110 715 363	1,377 933 428	-267 -217 -65
Eastside Contractors deliveries						
Water Rights	Delivery (annual average)	(TAF/year)	Long Term Dry Critical	502 524 406	514 524 486	-12 0 -80
CVP Service Contracts	Contract Delivery (annual average)	(TAF/year)	Long Term Dry Critical	100 69 8	118 98 25	-19 -29 -17
Total Eastside Contractors Deliveries						
Total Water Rights and CVP Service Contracts Deliveries	Delivery (annual average)	(TAF/year)	Long Term Dry Critical	602 593 414	632 621 511	-31 -29 -97

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text. 6) Annual deliveries are based on March to February Average.

Table 5C.3.2.15.5 CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP

	Stanislaus Deliveries		Difference from No Action Alternative		Difference from Second Basis of Comparison	
	CVP	Water Rights	CVP	Water Rights	CVP	Water Rights
	(TAF)	(TAF)	(TAF)	(TAF)	(TAF)	(TAF)
No Action Alternative	103.5	507.8				
Revised Second Basis of Comparison	118.3	514.0	14.8	6.2		
Alternative 2	103.5	507.8			-14.8	-6.2
Alternative 3	123.2	512.7	19.6	4.9	4.8	-1.2
Alternative 5	99.7	502.1	-3.8	-5.7	-18.6	-11.9

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

5C.3.2.16 CVP Total Generating Capacity

Table 5C.3.2.16.1 CVP Total Capacity, Monthly Capacity

No Action Alternative

Statistic	Monthly Capacity (MW)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,688	1,743	1,810	1,854	1,883	1,895	1,877	1,848	1,785	1,749	1,670	1,647
20%	1,638	1,724	1,772	1,829	1,858	1,872	1,842	1,806	1,719	1,695	1,623	1,615
30%	1,600	1,694	1,744	1,802	1,837	1,842	1,825	1,782	1,671	1,623	1,585	1,599
40%	1,579	1,635	1,710	1,776	1,811	1,812	1,793	1,736	1,634	1,583	1,545	1,553
50%	1,550	1,611	1,681	1,732	1,778	1,782	1,757	1,711	1,607	1,543	1,510	1,516
60%	1,529	1,556	1,622	1,700	1,749	1,752	1,725	1,652	1,564	1,504	1,481	1,473
70%	1,465	1,519	1,588	1,661	1,712	1,714	1,685	1,618	1,524	1,457	1,433	1,432
80%	1,354	1,428	1,521	1,584	1,666	1,675	1,637	1,578	1,440	1,353	1,332	1,342
90%	1,137	1,293	1,403	1,455	1,476	1,502	1,454	1,384	1,203	1,120	1,085	1,103
Long Term												
Full Simulation Period ^b	1,476	1,542	1,612	1,685	1,727	1,734	1,705	1,648	1,542	1,468	1,429	1,430
Water Year Types^c												
Wet (32%)	1,621	1,696	1,761	1,824	1,860	1,877	1,859	1,831	1,753	1,717	1,645	1,628
Above Normal (16%)	1,465	1,580	1,676	1,762	1,814	1,814	1,793	1,741	1,633	1,590	1,545	1,541
Below Normal (13%)	1,530	1,580	1,669	1,719	1,764	1,757	1,728	1,665	1,559	1,491	1,478	1,483
Dry (24%)	1,441	1,491	1,556	1,637	1,690	1,709	1,680	1,607	1,508	1,434	1,418	1,433
Critical (15%)	1,180	1,221	1,264	1,348	1,374	1,355	1,299	1,205	1,025	832	808	825

Revised Alternative 1

Statistic	Monthly Capacity (MW)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,773	1,820	1,859	1,890	1,911	1,950	1,942	1,907	1,822	1,762	1,756	1,742
20%	1,746	1,799	1,838	1,869	1,899	1,930	1,918	1,861	1,752	1,690	1,682	1,693
30%	1,701	1,778	1,823	1,859	1,892	1,909	1,897	1,824	1,699	1,626	1,621	1,658
40%	1,661	1,742	1,796	1,842	1,878	1,889	1,873	1,787	1,665	1,606	1,584	1,581
50%	1,594	1,703	1,761	1,819	1,858	1,874	1,840	1,764	1,622	1,557	1,552	1,553
60%	1,570	1,647	1,720	1,783	1,829	1,842	1,802	1,721	1,598	1,527	1,501	1,508
70%	1,501	1,573	1,664	1,726	1,786	1,799	1,774	1,681	1,567	1,491	1,453	1,460
80%	1,393	1,469	1,589	1,659	1,739	1,761	1,728	1,632	1,488	1,403	1,408	1,393
90%	1,235	1,374	1,447	1,554	1,588	1,576	1,546	1,454	1,350	1,236	1,196	1,227
Long Term												
Full Simulation Period ^b	1,550	1,626	1,698	1,754	1,797	1,814	1,791	1,712	1,590	1,509	1,486	1,494
Water Year Types^c												
Wet (32%)	1,688	1,765	1,818	1,863	1,898	1,932	1,925	1,876	1,780	1,724	1,701	1,708
Above Normal (16%)	1,537	1,667	1,774	1,825	1,869	1,891	1,874	1,791	1,664	1,598	1,583	1,580
Below Normal (13%)	1,622	1,684	1,766	1,803	1,842	1,850	1,819	1,730	1,602	1,512	1,494	1,500
Dry (24%)	1,490	1,558	1,629	1,711	1,769	1,789	1,763	1,670	1,550	1,482	1,464	1,473
Critical (15%)	1,297	1,340	1,408	1,470	1,506	1,485	1,429	1,323	1,155	987	948	968

Revised Alternative 1 minus No Action Alternative

Statistic	Monthly Capacity (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	5%	4%	3%	2%	1%	3%	3%	3%	2%	1%	5%	6%
20%	7%	4%	4%	2%	2%	3%	4%	3%	2%	0%	4%	5%
30%	6%	5%	5%	3%	3%	4%	4%	2%	2%	0%	2%	4%
40%	5%	7%	5%	4%	4%	4%	4%	3%	2%	1%	3%	2%
50%	3%	6%	5%	5%	4%	5%	5%	3%	1%	1%	3%	2%
60%	3%	6%	6%	5%	5%	5%	4%	4%	2%	2%	1%	2%
70%	2%	4%	5%	4%	4%	5%	5%	4%	3%	2%	1%	2%
80%	3%	3%	5%	5%	4%	5%	6%	3%	3%	4%	6%	4%
90%	9%	6%	3%	7%	8%	5%	6%	5%	12%	10%	10%	11%
Long Term												
Full Simulation Period ^b	5%	5%	5%	4%	4%	5%	5%	4%	3%	3%	4%	5%
Water Year Types^c												
Wet (32%)	4%	4%	3%	2%	2%	3%	4%	2%	1%	0%	3%	5%
Above Normal (16%)	5%	5%	6%	4%	3%	4%	5%	3%	2%	0%	2%	3%
Below Normal (13%)	6%	7%	6%	5%	4%	5%	5%	4%	3%	1%	1%	1%
Dry (24%)	3%	4%	5%	5%	5%	5%	4%	3%	3%	3%	3%	3%
Critical (15%)	10%	10%	11%	9%	10%	10%	10%	10%	13%	19%	17%	17%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.2.16.2 CVP Total Capacity, Monthly Capacity

Revised Second Basis of Comparison

Statistic	Monthly Capacity (MW)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,773	1,820	1,859	1,890	1,911	1,950	1,942	1,907	1,822	1,762	1,756	1,742
20%	1,746	1,799	1,838	1,869	1,899	1,930	1,918	1,861	1,752	1,690	1,682	1,693
30%	1,701	1,778	1,823	1,859	1,892	1,909	1,897	1,824	1,699	1,626	1,621	1,658
40%	1,661	1,742	1,796	1,842	1,878	1,889	1,873	1,787	1,665	1,606	1,584	1,581
50%	1,594	1,703	1,761	1,819	1,858	1,874	1,840	1,764	1,622	1,557	1,552	1,553
60%	1,570	1,647	1,720	1,783	1,829	1,842	1,802	1,721	1,598	1,527	1,501	1,508
70%	1,501	1,573	1,664	1,726	1,786	1,799	1,774	1,681	1,567	1,491	1,453	1,460
80%	1,393	1,469	1,589	1,659	1,739	1,761	1,728	1,632	1,488	1,403	1,408	1,393
90%	1,235	1,374	1,447	1,554	1,588	1,576	1,546	1,454	1,350	1,236	1,196	1,227
Long Term												
Full Simulation Period ^b	1,550	1,626	1,698	1,754	1,797	1,814	1,791	1,712	1,590	1,509	1,486	1,494
Water Year Types^c												
Wet (32%)	1,688	1,765	1,818	1,863	1,898	1,932	1,925	1,876	1,780	1,724	1,701	1,708
Above Normal (16%)	1,537	1,667	1,774	1,825	1,869	1,891	1,874	1,791	1,664	1,598	1,583	1,580
Below Normal (13%)	1,622	1,684	1,766	1,803	1,842	1,850	1,819	1,730	1,602	1,512	1,494	1,500
Dry (24%)	1,490	1,558	1,629	1,711	1,769	1,789	1,763	1,670	1,550	1,482	1,464	1,473
Critical (15%)	1,297	1,340	1,408	1,470	1,506	1,485	1,429	1,323	1,155	987	948	968

No Action Alternative

Statistic	Monthly Capacity (MW)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,688	1,743	1,810	1,854	1,883	1,895	1,877	1,848	1,785	1,749	1,670	1,647
20%	1,638	1,724	1,772	1,829	1,858	1,872	1,842	1,806	1,719	1,695	1,623	1,615
30%	1,600	1,694	1,744	1,802	1,837	1,842	1,825	1,782	1,671	1,623	1,585	1,599
40%	1,579	1,635	1,710	1,776	1,811	1,812	1,793	1,736	1,634	1,583	1,545	1,553
50%	1,550	1,611	1,681	1,732	1,778	1,782	1,757	1,711	1,607	1,543	1,510	1,516
60%	1,529	1,556	1,622	1,700	1,749	1,752	1,725	1,652	1,564	1,504	1,481	1,473
70%	1,465	1,519	1,588	1,661	1,712	1,714	1,685	1,618	1,524	1,457	1,433	1,432
80%	1,354	1,428	1,521	1,584	1,666	1,675	1,637	1,578	1,440	1,353	1,332	1,342
90%	1,137	1,293	1,403	1,455	1,476	1,502	1,454	1,384	1,203	1,120	1,085	1,103
Long Term												
Full Simulation Period ^b	1,476	1,542	1,612	1,685	1,727	1,734	1,705	1,648	1,542	1,468	1,429	1,430
Water Year Types^c												
Wet (32%)	1,621	1,696	1,761	1,824	1,860	1,877	1,859	1,831	1,753	1,717	1,645	1,628
Above Normal (16%)	1,465	1,580	1,676	1,762	1,814	1,814	1,793	1,741	1,633	1,590	1,545	1,541
Below Normal (13%)	1,530	1,580	1,669	1,719	1,764	1,757	1,728	1,665	1,559	1,491	1,478	1,483
Dry (24%)	1,441	1,491	1,556	1,637	1,690	1,709	1,680	1,607	1,508	1,434	1,418	1,433
Critical (15%)	1,180	1,221	1,264	1,348	1,374	1,355	1,299	1,205	1,025	832	808	825

No Action Alternative minus Revised Second Basis of Comparison

Statistic	Monthly Capacity (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-5%	-4%	-3%	-2%	-1%	-3%	-3%	-3%	-2%	-1%	-5%	-5%
20%	-6%	-4%	-4%	-2%	-2%	-3%	-4%	-3%	-2%	0%	-4%	-5%
30%	-6%	-5%	-4%	-3%	-3%	-3%	-4%	-2%	-2%	0%	-2%	-4%
40%	-5%	-6%	-5%	-4%	-4%	-4%	-4%	-3%	-2%	-1%	-2%	-2%
50%	-3%	-5%	-5%	-5%	-4%	-5%	-5%	-3%	-1%	-1%	-3%	-2%
60%	-3%	-6%	-6%	-5%	-4%	-5%	-4%	-4%	-2%	-1%	-1%	-2%
70%	-2%	-3%	-5%	-4%	-4%	-5%	-5%	-4%	-3%	-2%	-1%	-2%
80%	-3%	-3%	-4%	-5%	-4%	-5%	-5%	-3%	-3%	-4%	-5%	-4%
90%	-8%	-6%	-3%	-6%	-7%	-5%	-6%	-5%	-11%	-9%	-9%	-10%
Long Term												
Full Simulation Period ^b	-5%	-5%	-5%	-4%	-4%	-4%	-5%	-4%	-3%	-3%	-4%	-4%
Water Year Types^c												
Wet (32%)	-4%	-4%	-3%	-2%	-2%	-3%	-3%	-2%	-1%	0%	-3%	-5%
Above Normal (16%)	-5%	-5%	-5%	-3%	-3%	-4%	-4%	-3%	-2%	0%	-2%	-2%
Below Normal (13%)	-6%	-6%	-6%	-5%	-4%	-5%	-5%	-4%	-3%	-1%	-1%	-1%
Dry (24%)	-3%	-4%	-4%	-4%	-4%	-4%	-5%	-4%	-3%	-3%	-3%	-3%
Critical (15%)	-9%	-9%	-10%	-8%	-9%	-9%	-9%	-9%	-11%	-16%	-15%	-15%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.2.16.3 CVP Total Capacity, Monthly Capacity

Revised Second Basis of Comparison

Statistic	Monthly Capacity (MW)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,773	1,820	1,859	1,890	1,911	1,950	1,942	1,907	1,822	1,762	1,756	1,742
20%	1,746	1,799	1,838	1,869	1,899	1,930	1,918	1,861	1,752	1,690	1,682	1,693
30%	1,701	1,778	1,823	1,859	1,892	1,909	1,897	1,824	1,699	1,626	1,621	1,658
40%	1,661	1,742	1,796	1,842	1,878	1,889	1,873	1,787	1,665	1,606	1,584	1,581
50%	1,594	1,703	1,761	1,819	1,858	1,874	1,840	1,764	1,622	1,557	1,552	1,553
60%	1,570	1,647	1,720	1,783	1,829	1,842	1,802	1,721	1,598	1,527	1,501	1,508
70%	1,501	1,573	1,664	1,726	1,786	1,799	1,774	1,681	1,567	1,491	1,453	1,460
80%	1,393	1,469	1,589	1,659	1,739	1,761	1,728	1,632	1,488	1,403	1,408	1,393
90%	1,235	1,374	1,447	1,554	1,588	1,576	1,546	1,454	1,350	1,236	1,196	1,227
Long Term												
Full Simulation Period ^b	1,550	1,626	1,698	1,754	1,797	1,814	1,791	1,712	1,590	1,509	1,486	1,494
Water Year Types^c												
Wet (32%)	1,688	1,765	1,818	1,863	1,898	1,932	1,925	1,876	1,780	1,724	1,701	1,708
Above Normal (16%)	1,537	1,667	1,774	1,825	1,869	1,891	1,874	1,791	1,664	1,598	1,583	1,580
Below Normal (13%)	1,622	1,684	1,766	1,803	1,842	1,850	1,819	1,730	1,602	1,512	1,494	1,500
Dry (24%)	1,490	1,558	1,629	1,711	1,769	1,789	1,763	1,670	1,550	1,482	1,464	1,473
Critical (15%)	1,297	1,340	1,408	1,470	1,506	1,485	1,429	1,323	1,155	987	948	968

Alternative 3

Statistic	Monthly Capacity (MW)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,778	1,818	1,852	1,884	1,910	1,945	1,947	1,910	1,837	1,777	1,759	1,753
20%	1,749	1,789	1,828	1,860	1,894	1,930	1,930	1,883	1,766	1,692	1,687	1,696
30%	1,708	1,772	1,814	1,851	1,884	1,900	1,895	1,828	1,717	1,654	1,633	1,659
40%	1,663	1,741	1,781	1,838	1,866	1,882	1,849	1,777	1,670	1,601	1,604	1,600
50%	1,609	1,689	1,744	1,800	1,840	1,851	1,821	1,760	1,644	1,572	1,554	1,569
60%	1,579	1,639	1,695	1,748	1,797	1,814	1,781	1,711	1,603	1,542	1,511	1,510
70%	1,499	1,557	1,632	1,703	1,768	1,784	1,755	1,665	1,567	1,487	1,453	1,465
80%	1,394	1,457	1,570	1,624	1,708	1,738	1,707	1,620	1,506	1,408	1,378	1,372
90%	1,231	1,365	1,434	1,496	1,518	1,545	1,519	1,453	1,343	1,229	1,190	1,181
Long Term												
Full Simulation Period ^b	1,551	1,613	1,676	1,732	1,777	1,794	1,775	1,705	1,592	1,512	1,486	1,493
Water Year Types^c												
Wet (32%)	1,690	1,756	1,806	1,856	1,894	1,929	1,928	1,885	1,791	1,730	1,713	1,716
Above Normal (16%)	1,527	1,640	1,746	1,802	1,852	1,875	1,862	1,786	1,679	1,615	1,591	1,589
Below Normal (13%)	1,629	1,676	1,751	1,790	1,829	1,832	1,788	1,718	1,607	1,529	1,504	1,501
Dry (24%)	1,504	1,551	1,612	1,686	1,748	1,768	1,745	1,660	1,555	1,479	1,459	1,475
Critical (15%)	1,283	1,319	1,355	1,411	1,444	1,422	1,386	1,288	1,113	967	909	930

Alternative 3 minus Revised Second Basis of Comparison

Statistic	Monthly Capacity (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	1%	1%	0%	1%
20%	0%	-1%	-1%	0%	0%	0%	1%	1%	1%	0%	0%	0%
30%	0%	0%	-1%	0%	0%	0%	0%	0%	1%	2%	1%	0%
40%	0%	0%	-1%	0%	-1%	0%	-1%	-1%	0%	0%	1%	1%
50%	1%	-1%	-1%	-1%	-1%	-1%	-1%	0%	1%	1%	0%	1%
60%	1%	-1%	-1%	-2%	-2%	-2%	-1%	-1%	0%	1%	1%	0%
70%	0%	-1%	-2%	-1%	-1%	-1%	-1%	-1%	0%	0%	0%	0%
80%	0%	-1%	-1%	-2%	-2%	-1%	-1%	-1%	1%	0%	-2%	-2%
90%	0%	-1%	-1%	-4%	-4%	-2%	-2%	0%	-1%	-1%	0%	-4%
Long Term												
Full Simulation Period ^b	0%	-1%	-1%	-1%	-1%	-1%	-1%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	-1%	-1%	0%	0%	0%	0%	0%	1%	0%	1%	0%
Above Normal (16%)	-1%	-2%	-2%	-1%	-1%	-1%	-1%	0%	1%	1%	0%	1%
Below Normal (13%)	0%	0%	-1%	-1%	-1%	-1%	-2%	-1%	0%	1%	1%	0%
Dry (24%)	1%	0%	-1%	-1%	-1%	-1%	-1%	-1%	0%	0%	0%	0%
Critical (15%)	-1%	-2%	-4%	-4%	-4%	-4%	-3%	-3%	-4%	-2%	-4%	-4%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.2.16.4 CVP Total Capacity, Monthly Capacity

Revised Second Basis of Comparison

Statistic	Monthly Capacity (MW)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,773	1,820	1,859	1,890	1,911	1,950	1,942	1,907	1,822	1,762	1,756	1,742
20%	1,746	1,799	1,838	1,869	1,899	1,930	1,918	1,861	1,752	1,690	1,682	1,693
30%	1,701	1,778	1,823	1,859	1,892	1,909	1,897	1,824	1,699	1,626	1,621	1,658
40%	1,661	1,742	1,796	1,842	1,878	1,889	1,873	1,787	1,665	1,606	1,584	1,581
50%	1,594	1,703	1,761	1,819	1,858	1,874	1,840	1,764	1,622	1,557	1,552	1,553
60%	1,570	1,647	1,720	1,783	1,829	1,842	1,802	1,721	1,598	1,527	1,501	1,508
70%	1,501	1,573	1,664	1,726	1,786	1,799	1,774	1,681	1,567	1,491	1,453	1,460
80%	1,393	1,469	1,589	1,659	1,739	1,761	1,728	1,632	1,488	1,403	1,408	1,393
90%	1,235	1,374	1,447	1,554	1,588	1,576	1,546	1,454	1,350	1,236	1,196	1,227
Long Term												
Full Simulation Period ^b	1,550	1,626	1,698	1,754	1,797	1,814	1,791	1,712	1,590	1,509	1,486	1,494
Water Year Types^c												
Wet (32%)	1,688	1,765	1,818	1,863	1,898	1,932	1,925	1,876	1,780	1,724	1,701	1,708
Above Normal (16%)	1,537	1,667	1,774	1,825	1,869	1,891	1,874	1,791	1,664	1,598	1,583	1,580
Below Normal (13%)	1,622	1,684	1,766	1,803	1,842	1,850	1,819	1,730	1,602	1,512	1,494	1,500
Dry (24%)	1,490	1,558	1,629	1,711	1,769	1,789	1,763	1,670	1,550	1,482	1,464	1,473
Critical (15%)	1,297	1,340	1,408	1,470	1,506	1,485	1,429	1,323	1,155	987	948	968

Alternative 5

Statistic	Monthly Capacity (MW)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,693	1,746	1,805	1,849	1,882	1,891	1,879	1,849	1,777	1,748	1,671	1,650
20%	1,635	1,721	1,772	1,829	1,859	1,867	1,843	1,806	1,725	1,690	1,624	1,612
30%	1,599	1,680	1,744	1,797	1,836	1,839	1,816	1,766	1,655	1,616	1,576	1,579
40%	1,566	1,638	1,710	1,767	1,801	1,801	1,785	1,732	1,619	1,571	1,538	1,547
50%	1,538	1,596	1,668	1,726	1,775	1,774	1,737	1,700	1,598	1,555	1,504	1,510
60%	1,516	1,552	1,617	1,687	1,737	1,733	1,701	1,643	1,537	1,484	1,460	1,457
70%	1,458	1,512	1,571	1,650	1,694	1,699	1,673	1,596	1,506	1,415	1,413	1,413
80%	1,327	1,399	1,504	1,574	1,644	1,639	1,616	1,532	1,439	1,324	1,302	1,310
90%	1,044	1,242	1,372	1,427	1,440	1,483	1,450	1,351	1,173	1,061	1,046	1,029
Long Term												
Full Simulation Period ^b	1,460	1,532	1,603	1,672	1,716	1,717	1,692	1,633	1,525	1,450	1,410	1,410
Water Year Types^c												
Wet (32%)	1,609	1,690	1,755	1,819	1,856	1,873	1,858	1,830	1,748	1,715	1,641	1,625
Above Normal (16%)	1,458	1,576	1,671	1,757	1,808	1,806	1,785	1,735	1,624	1,577	1,536	1,532
Below Normal (13%)	1,504	1,559	1,648	1,712	1,755	1,743	1,710	1,653	1,546	1,474	1,465	1,468
Dry (24%)	1,428	1,478	1,545	1,622	1,676	1,686	1,657	1,585	1,485	1,403	1,383	1,391
Critical (15%)	1,152	1,205	1,253	1,308	1,344	1,310	1,274	1,159	985	793	768	794

Alternative 5 minus Revised Second Basis of Comparison

Statistic	Monthly Capacity (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-5%	-4%	-3%	-2%	-2%	-3%	-3%	-3%	-2%	-1%	-5%	-5%
20%	-6%	-4%	-4%	-2%	-2%	-3%	-4%	-3%	-2%	0%	-3%	-5%
30%	-6%	-6%	-4%	-3%	-3%	-4%	-4%	-3%	-3%	-1%	-3%	-5%
40%	-6%	-6%	-5%	-4%	-4%	-5%	-5%	-3%	-3%	-2%	-3%	-2%
50%	-4%	-6%	-5%	-5%	-4%	-5%	-6%	-4%	-1%	0%	-3%	-3%
60%	-3%	-6%	-6%	-5%	-5%	-6%	-6%	-5%	-4%	-3%	-3%	-3%
70%	-3%	-4%	-6%	-4%	-5%	-6%	-6%	-5%	-4%	-5%	-3%	-3%
80%	-5%	-5%	-5%	-5%	-5%	-7%	-6%	-6%	-3%	-6%	-8%	-6%
90%	-15%	-10%	-5%	-8%	-9%	-6%	-6%	-7%	-13%	-14%	-12%	-16%
Long Term												
Full Simulation Period ^b	-6%	-6%	-6%	-5%	-5%	-5%	-6%	-5%	-4%	-4%	-5%	-6%
Water Year Types^c												
Wet (32%)	-5%	-4%	-3%	-2%	-2%	-3%	-3%	-2%	-2%	0%	-4%	-5%
Above Normal (16%)	-5%	-5%	-6%	-4%	-3%	-4%	-5%	-3%	-2%	-1%	-3%	-3%
Below Normal (13%)	-7%	-7%	-7%	-5%	-5%	-6%	-6%	-4%	-3%	-3%	-2%	-2%
Dry (24%)	-4%	-5%	-5%	-5%	-5%	-6%	-6%	-5%	-4%	-5%	-6%	-6%
Critical (15%)	-11%	-10%	-11%	-11%	-11%	-12%	-11%	-12%	-15%	-20%	-19%	-18%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

5C.3.2.17 CVP Total Generation

Table 5C.3.2.17.1 CVP Total Generation, Monthly Generation

No Action Alternative

Statistic	Monthly Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	409	413	641	689	671	696	492	616	619	756	585	630
20%	372	380	338	490	622	569	397	549	577	729	549	597
30%	329	310	240	381	471	363	358	514	561	705	536	469
40%	292	274	190	235	245	267	334	478	544	662	511	414
50%	270	231	175	201	205	229	318	464	527	644	496	342
60%	239	183	167	179	173	194	302	442	495	630	476	285
70%	210	162	146	152	141	171	282	415	479	598	451	250
80%	186	140	131	137	130	151	249	350	435	551	421	215
90%	159	118	105	120	110	141	217	291	350	474	359	184
Long Term												
Full Simulation Period ^b	273	255	260	317	322	329	343	461	514	631	487	376
Water Year Types^c												
Wet (32%)	317	318	441	558	513	557	447	580	568	683	542	598
Above Normal (16%)	268	263	259	320	454	367	370	484	544	708	527	421
Below Normal (13%)	310	258	175	186	266	220	318	455	540	679	529	289
Dry (24%)	254	232	154	183	145	183	263	406	511	607	457	246
Critical (15%)	184	149	123	134	111	135	242	271	345	431	333	145

Revised Alternative 1

Statistic	Monthly Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	416	296	658	692	692	710	488	631	701	773	637	443
20%	334	254	432	581	649	584	390	566	658	755	593	370
30%	302	232	240	439	446	368	347	535	619	732	570	337
40%	278	219	195	265	286	261	327	507	590	708	550	316
50%	237	206	181	207	219	226	312	492	565	688	527	298
60%	218	179	170	175	173	192	294	464	551	662	503	280
70%	199	167	147	153	144	175	280	442	531	628	479	259
80%	172	138	133	138	134	153	252	372	481	582	436	226
90%	152	124	113	121	115	139	221	314	389	472	392	191
Long Term												
Full Simulation Period ^b	257	215	278	334	335	335	337	481	566	659	517	307
Water Year Types^c												
Wet (32%)	296	269	491	581	531	551	430	588	624	700	577	402
Above Normal (16%)	241	215	246	359	481	398	345	511	615	741	572	340
Below Normal (13%)	285	221	186	227	282	245	326	490	612	724	577	303
Dry (24%)	248	183	158	177	150	179	266	429	543	639	462	252
Critical (15%)	181	148	134	133	109	141	257	297	386	452	362	161

Revised Alternative 1 minus No Action Alternative

Statistic	Monthly Generation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2%	-28%	3%	0%	3%	2%	-1%	2%	13%	2%	9%	-30%
20%	-10%	-33%	28%	19%	4%	3%	-2%	3%	14%	4%	8%	-38%
30%	-8%	-25%	0%	15%	-5%	1%	-3%	4%	10%	4%	6%	-28%
40%	-5%	-20%	3%	13%	17%	-2%	-2%	6%	8%	7%	8%	-24%
50%	-12%	-11%	3%	3%	7%	-1%	-2%	6%	7%	7%	6%	-13%
60%	-9%	-2%	2%	-2%	0%	-1%	-3%	5%	11%	5%	6%	-2%
70%	-5%	3%	0%	1%	2%	2%	-1%	6%	11%	5%	6%	3%
80%	-8%	-2%	2%	1%	4%	1%	1%	6%	11%	6%	4%	5%
90%	-4%	5%	8%	1%	5%	-1%	2%	8%	11%	-1%	9%	4%
Long Term												
Full Simulation Period ^b	-6%	-16%	7%	6%	4%	2%	-2%	4%	10%	4%	6%	-18%
Water Year Types^c												
Wet (32%)	-7%	-15%	12%	4%	3%	-1%	-4%	1%	10%	3%	6%	-33%
Above Normal (16%)	-10%	-18%	-5%	12%	6%	8%	-7%	6%	13%	5%	8%	-19%
Below Normal (13%)	-8%	-14%	6%	22%	6%	11%	3%	8%	13%	7%	9%	5%
Dry (24%)	-2%	-21%	3%	-3%	4%	-2%	1%	6%	6%	5%	1%	2%
Critical (15%)	-1%	-1%	9%	0%	-2%	5%	6%	10%	12%	5%	9%	11%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.2.17.2 CVP Total Generation, Monthly Generation

Revised Second Basis of Comparison

Statistic	Monthly Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	416	296	658	692	692	710	488	631	701	773	637	443
20%	334	254	432	581	649	584	390	566	658	755	593	370
30%	302	232	240	439	446	368	347	535	619	732	570	337
40%	278	219	195	265	286	261	327	507	590	708	550	316
50%	237	206	181	207	219	226	312	492	565	688	527	298
60%	218	179	170	175	173	192	294	464	551	662	503	280
70%	199	167	147	153	144	175	280	442	531	628	479	259
80%	172	138	133	138	134	153	252	372	481	582	436	226
90%	152	124	113	121	115	139	221	314	389	472	392	191
Long Term												
Full Simulation Period ^b	257	215	278	334	335	335	337	481	566	659	517	307
Water Year Types^c												
Wet (32%)	296	269	491	581	531	551	430	588	624	700	577	402
Above Normal (16%)	241	215	246	359	481	398	345	511	615	741	572	340
Below Normal (13%)	285	221	186	227	282	245	326	490	612	724	577	303
Dry (24%)	248	183	158	177	150	179	266	429	543	639	462	252
Critical (15%)	181	148	134	133	109	141	257	297	386	452	362	161

No Action Alternative

Statistic	Monthly Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	409	413	641	689	671	696	492	616	619	756	585	630
20%	372	380	338	490	622	569	397	549	577	729	549	597
30%	329	310	240	381	471	363	358	514	561	705	536	469
40%	292	274	190	235	245	267	334	478	544	662	511	414
50%	270	231	175	201	205	229	318	464	527	644	496	342
60%	239	183	167	179	173	194	302	442	495	630	476	285
70%	210	162	146	152	141	171	282	415	479	598	451	250
80%	186	140	131	137	130	151	249	350	435	551	421	215
90%	159	118	105	120	110	141	217	291	350	474	359	184
Long Term												
Full Simulation Period ^b	273	255	260	317	322	329	343	461	514	631	487	376
Water Year Types^c												
Wet (32%)	317	318	441	558	513	557	447	580	568	683	542	598
Above Normal (16%)	268	263	259	320	454	367	370	484	544	708	527	421
Below Normal (13%)	310	258	175	186	266	220	318	455	540	679	529	289
Dry (24%)	254	232	154	183	145	183	263	406	511	607	457	246
Critical (15%)	184	149	123	134	111	135	242	271	345	431	333	145

No Action Alternative minus Revised Second Basis of Comparison

Statistic	Monthly Generation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-2%	39%	-3%	0%	-3%	-2%	1%	-2%	-12%	-2%	-8%	42%
20%	11%	49%	-22%	-16%	-4%	-2%	2%	-3%	-12%	-3%	-7%	61%
30%	9%	33%	0%	-13%	6%	-1%	3%	-4%	-9%	-4%	-6%	39%
40%	5%	25%	-3%	-11%	-14%	2%	2%	-6%	-8%	-7%	-7%	31%
50%	14%	12%	-3%	-3%	-6%	1%	2%	-6%	-7%	-6%	-6%	15%
60%	10%	2%	-2%	2%	0%	1%	3%	-5%	-10%	-5%	-5%	2%
70%	5%	-3%	0%	-1%	-2%	-2%	1%	-6%	-10%	-5%	-6%	-3%
80%	8%	2%	-2%	-1%	-3%	-1%	-1%	-6%	-10%	-5%	-3%	-5%
90%	5%	-5%	-7%	-1%	-5%	1%	-2%	-7%	-10%	1%	-8%	-4%
Long Term												
Full Simulation Period ^b	6%	19%	-6%	-5%	-4%	-2%	2%	-4%	-9%	-4%	-6%	23%
Water Year Types^c												
Wet (32%)	7%	18%	-10%	-4%	-3%	1%	4%	-1%	-9%	-2%	-6%	49%
Above Normal (16%)	11%	22%	6%	-11%	-6%	-8%	7%	-5%	-12%	-4%	-8%	24%
Below Normal (13%)	9%	17%	-6%	-18%	-6%	-10%	-2%	-7%	-12%	-6%	-8%	-5%
Dry (24%)	2%	27%	-3%	3%	-3%	2%	-1%	-5%	-6%	-5%	-1%	-2%
Critical (15%)	1%	1%	-8%	0%	2%	-4%	-6%	-9%	-11%	-5%	-8%	-10%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.2.17.3 CVP Total Generation, Monthly Generation

Revised Second Basis of Comparison

Statistic	Monthly Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	416	296	658	692	692	710	488	631	701	773	637	443
20%	334	254	432	581	649	584	390	566	658	755	593	370
30%	302	232	240	439	446	368	347	535	619	732	570	337
40%	278	219	195	265	286	261	327	507	590	708	550	316
50%	237	206	181	207	219	226	312	492	565	688	527	298
60%	218	179	170	175	173	192	294	464	551	662	503	280
70%	199	167	147	153	144	175	280	442	531	628	479	259
80%	172	138	133	138	134	153	252	372	481	582	436	226
90%	152	124	113	121	115	139	221	314	389	472	392	191
Long Term												
Full Simulation Period ^b	257	215	278	334	335	335	337	481	566	659	517	307
Water Year Types^c												
Wet (32%)	296	269	491	581	531	551	430	588	624	700	577	402
Above Normal (16%)	241	215	246	359	481	398	345	511	615	741	572	340
Below Normal (13%)	285	221	186	227	282	245	326	490	612	724	577	303
Dry (24%)	248	183	158	177	150	179	266	429	543	639	462	252
Critical (15%)	181	148	134	133	109	141	257	297	386	452	362	161

Alternative 3

Statistic	Monthly Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	415	306	662	691	701	710	489	598	648	775	610	459
20%	342	256	426	590	650	583	393	551	635	759	578	387
30%	314	227	242	427	458	367	360	507	590	741	557	358
40%	275	216	199	254	283	258	330	493	564	720	538	328
50%	245	204	181	203	220	223	314	469	548	678	525	302
60%	222	180	170	173	179	192	291	442	518	657	513	279
70%	202	164	149	156	142	171	271	421	511	624	482	257
80%	176	145	133	134	128	153	250	363	453	561	445	227
90%	158	124	113	122	109	136	222	300	381	474	387	191
Long Term												
Full Simulation Period ^b	262	215	279	333	336	335	338	462	542	658	512	314
Water Year Types^c												
Wet (32%)	298	268	493	584	537	551	430	562	593	712	576	407
Above Normal (16%)	249	222	245	350	477	401	346	482	580	736	550	341
Below Normal (13%)	284	211	187	228	283	245	332	476	580	711	557	347
Dry (24%)	256	184	162	175	146	180	265	416	532	635	471	251
Critical (15%)	189	150	132	130	113	139	253	285	373	445	360	160

Alternative 3 minus Revised Second Basis of Comparison

Statistic	Monthly Generation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	3%	1%	0%	1%	0%	0%	-5%	-7%	0%	-4%	4%
20%	2%	0%	-1%	1%	0%	0%	1%	-3%	-3%	0%	-2%	5%
30%	4%	-2%	1%	-3%	3%	0%	4%	-5%	-5%	1%	-2%	6%
40%	-1%	-1%	2%	-4%	-1%	-1%	1%	-3%	-4%	2%	-2%	4%
50%	4%	-1%	0%	-2%	1%	-2%	0%	-5%	-3%	-1%	0%	1%
60%	2%	1%	0%	-2%	3%	0%	-1%	-5%	-6%	-1%	2%	0%
70%	2%	-1%	2%	2%	-2%	-2%	-3%	-5%	-4%	-1%	1%	-1%
80%	2%	5%	0%	-3%	-5%	0%	-1%	-3%	-6%	-3%	2%	0%
90%	4%	0%	1%	0%	-5%	-2%	0%	-4%	-2%	0%	-1%	0%
Long Term												
Full Simulation Period ^b	2%	0%	0%	0%	0%	0%	0%	-4%	-4%	0%	-1%	2%
Water Year Types^c												
Wet (32%)	1%	-1%	0%	1%	1%	0%	0%	-4%	-5%	2%	0%	1%
Above Normal (16%)	3%	3%	0%	-2%	-1%	1%	0%	-6%	-6%	-1%	-4%	0%
Below Normal (13%)	0%	-4%	0%	1%	0%	0%	2%	-3%	-5%	-2%	-4%	14%
Dry (24%)	3%	1%	2%	-1%	-3%	1%	0%	-3%	-2%	-1%	2%	0%
Critical (15%)	4%	1%	-2%	-2%	4%	-1%	-2%	-4%	-3%	-2%	-1%	-1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.2.17.4 CVP Total Generation, Monthly Generation

Revised Second Basis of Comparison

Statistic	Monthly Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	416	296	658	692	692	710	488	631	701	773	637	443
20%	334	254	432	581	649	584	390	566	658	755	593	370
30%	302	232	240	439	446	368	347	535	619	732	570	337
40%	278	219	195	265	286	261	327	507	590	708	550	316
50%	237	206	181	207	219	226	312	492	565	688	527	298
60%	218	179	170	175	173	192	294	464	551	662	503	280
70%	199	167	147	153	144	175	280	442	531	628	479	259
80%	172	138	133	138	134	153	252	372	481	582	436	226
90%	152	124	113	121	115	139	221	314	389	472	392	191
Long Term												
Full Simulation Period ^b	257	215	278	334	335	335	337	481	566	659	517	307
Water Year Types^c												
Wet (32%)	296	269	491	581	531	551	430	588	624	700	577	402
Above Normal (16%)	241	215	246	359	481	398	345	511	615	741	572	340
Below Normal (13%)	285	221	186	227	282	245	326	490	612	724	577	303
Dry (24%)	248	183	158	177	150	179	266	429	543	639	462	252
Critical (15%)	181	148	134	133	109	141	257	297	386	452	362	161

Alternative 5

Statistic	Monthly Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	404	410	647	689	671	694	491	627	618	752	574	628
20%	365	380	341	486	622	563	404	562	578	722	553	598
30%	328	316	236	381	459	362	368	513	557	705	534	468
40%	284	281	188	233	245	266	334	482	541	660	514	418
50%	269	226	173	201	205	229	327	460	525	648	498	351
60%	244	182	163	178	173	199	304	439	493	634	471	277
70%	220	161	145	153	139	170	281	412	472	601	451	248
80%	183	140	131	137	127	151	258	343	432	548	416	217
90%	155	113	102	120	108	136	233	308	350	463	365	184
Long Term												
Full Simulation Period ^b	273	254	258	317	321	328	348	463	509	628	485	378
Water Year Types^c												
Wet (32%)	313	320	438	558	512	554	446	585	567	685	538	598
Above Normal (16%)	266	254	259	321	454	368	370	489	542	708	523	419
Below Normal (13%)	307	257	173	186	265	221	334	458	533	675	520	294
Dry (24%)	254	231	153	183	145	183	273	404	505	604	459	247
Critical (15%)	192	149	120	135	110	132	250	270	336	414	337	153

Alternative 5 minus Revised Second Basis of Comparison

Statistic	Monthly Generation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-3%	38%	-2%	0%	-3%	-2%	1%	-1%	-12%	-3%	-10%	42%
20%	9%	49%	-21%	-16%	-4%	-4%	4%	-1%	-12%	-4%	-7%	62%
30%	9%	36%	-1%	-13%	3%	-2%	6%	-4%	-10%	-4%	-6%	39%
40%	2%	28%	-3%	-12%	-14%	2%	2%	-5%	-8%	-7%	-7%	32%
50%	14%	10%	-4%	-3%	-6%	1%	5%	-7%	-7%	-6%	-6%	18%
60%	12%	2%	-4%	2%	0%	3%	3%	-5%	-11%	-4%	-6%	-1%
70%	11%	-3%	-1%	0%	-4%	-3%	0%	-7%	-11%	-4%	-6%	-4%
80%	7%	1%	-2%	-1%	-5%	-1%	3%	-8%	-10%	-6%	-5%	-4%
90%	2%	-9%	-9%	-1%	-6%	-2%	5%	-2%	-10%	-2%	-7%	-4%
Long Term												
Full Simulation Period ^b	6%	18%	-7%	-5%	-4%	-2%	3%	-4%	-10%	-5%	-6%	23%
Water Year Types^c												
Wet (32%)	6%	19%	-11%	-4%	-4%	1%	4%	0%	-9%	-2%	-7%	49%
Above Normal (16%)	10%	18%	5%	-11%	-6%	-8%	7%	-4%	-12%	-4%	-9%	23%
Below Normal (13%)	8%	16%	-7%	-18%	-6%	-10%	2%	-7%	-13%	-7%	-10%	-3%
Dry (24%)	2%	26%	-3%	3%	-3%	2%	2%	-6%	-7%	-6%	-1%	-2%
Critical (15%)	6%	1%	-10%	1%	1%	-6%	-3%	-9%	-13%	-8%	-7%	-5%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

5C.3.2.18 CVP Total Energy Use

Table 5C.3.2.18.1 CVP Total Energy Use, Monthly Energy Use

No Action Alternative

Statistic	Monthly Energy Use (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	111	171	154	153	146	149	60	69	128	153	133	106
20%	95	150	149	131	133	138	43	46	103	139	122	105
30%	85	139	142	118	115	109	37	41	88	122	114	103
40%	76	129	134	113	99	98	35	39	78	114	109	96
50%	72	105	129	110	94	75	32	36	65	104	102	87
60%	67	93	123	105	85	65	31	33	58	93	94	76
70%	62	81	115	95	72	61	29	30	44	84	79	68
80%	57	65	96	83	47	46	25	26	34	69	59	58
90%	54	58	74	71	31	22	21	21	21	42	36	45
Long Term												
Full Simulation Period ^b	76	111	121	108	92	86	36	40	71	101	93	82
Water Year Types^c												
Wet (32%)	81	125	130	124	125	122	50	58	113	132	119	94
Above Normal (16%)	74	120	123	97	91	104	36	40	85	99	108	87
Below Normal (13%)	79	122	132	107	84	76	30	33	61	106	106	92
Dry (24%)	76	103	120	108	77	64	30	30	42	90	65	72
Critical (15%)	65	73	89	85	52	31	21	22	22	51	56	57

Revised Alternative 1

Statistic	Monthly Energy Use (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	137	152	163	173	189	145	83	90	114	163	178	109
20%	121	140	159	167	148	128	81	64	103	156	153	108
30%	118	139	157	163	142	103	80	59	96	148	132	107
40%	96	131	155	162	138	82	75	53	91	140	128	106
50%	74	123	152	160	135	68	69	46	87	131	123	105
60%	65	108	143	157	99	67	63	43	78	117	110	90
70%	54	96	128	147	77	62	49	38	64	97	85	83
80%	44	77	119	123	48	52	36	28	43	86	54	68
90%	32	67	86	74	25	28	22	23	25	42	39	49
Long Term												
Full Simulation Period ^b	84	114	136	148	114	84	61	50	77	118	113	92
Water Year Types^c												
Wet (32%)	99	131	154	168	137	96	79	69	102	145	149	109
Above Normal (16%)	73	115	136	148	133	93	79	57	100	129	135	115
Below Normal (13%)	93	135	149	157	99	85	61	51	83	147	139	93
Dry (24%)	86	101	125	139	103	84	43	36	55	105	67	75
Critical (15%)	52	76	106	109	78	50	30	24	30	45	61	58

Revised Alternative 1 minus No Action Alternative

Statistic	Monthly Energy Use (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	23%	-11%	5%	13%	30%	-2%	39%	31%	-11%	7%	34%	3%
20%	27%	-7%	7%	27%	11%	-8%	90%	40%	1%	12%	25%	3%
30%	39%	-1%	11%	39%	23%	-6%	114%	44%	9%	21%	16%	3%
40%	27%	2%	16%	43%	39%	-17%	118%	37%	17%	23%	18%	10%
50%	3%	17%	18%	46%	44%	-8%	113%	30%	34%	26%	21%	20%
60%	-3%	16%	16%	49%	17%	2%	106%	33%	34%	26%	17%	18%
70%	-13%	18%	11%	54%	8%	2%	68%	26%	44%	14%	7%	23%
80%	-23%	18%	24%	49%	3%	13%	44%	8%	29%	25%	-8%	17%
90%	-42%	14%	16%	5%	-20%	27%	2%	6%	20%	0%	7%	9%
Long Term												
Full Simulation Period ^b	10%	3%	13%	36%	25%	-1%	69%	25%	9%	17%	21%	13%
Water Year Types^c												
Wet (32%)	21%	5%	19%	35%	10%	-21%	59%	18%	-10%	9%	25%	16%
Above Normal (16%)	-1%	-4%	11%	53%	46%	-11%	119%	42%	18%	30%	25%	32%
Below Normal (13%)	18%	11%	13%	46%	17%	11%	105%	53%	35%	39%	32%	1%
Dry (24%)	13%	-3%	4%	28%	34%	31%	42%	20%	31%	18%	3%	4%
Critical (15%)	-20%	4%	19%	27%	51%	63%	47%	8%	33%	-12%	9%	3%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.2.18.2 CVP Total Energy Use, Monthly Energy Use

Revised Second Basis of Comparison

Statistic	Monthly Energy Use (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	137	152	163	173	189	145	83	90	114	163	178	109
20%	121	140	159	167	148	128	81	64	103	156	153	108
30%	118	139	157	163	142	103	80	59	96	148	132	107
40%	96	131	155	162	138	82	75	53	91	140	128	106
50%	74	123	152	160	135	68	69	46	87	131	123	105
60%	65	108	143	157	99	67	63	43	78	117	110	90
70%	54	96	128	147	77	62	49	38	64	97	85	83
80%	44	77	119	123	48	52	36	28	43	86	54	68
90%	32	67	86	74	25	28	22	23	25	42	39	49
Long Term												
Full Simulation Period ^b	84	114	136	148	114	84	61	50	77	118	113	92
Water Year Types^c												
Wet (32%)	99	131	154	168	137	96	79	69	102	145	149	109
Above Normal (16%)	73	115	136	148	133	93	79	57	100	129	135	115
Below Normal (13%)	93	135	149	157	99	85	61	51	83	147	139	93
Dry (24%)	86	101	125	139	103	84	43	36	55	105	67	75
Critical (15%)	52	76	106	109	78	50	30	24	30	45	61	58

No Action Alternative

Statistic	Monthly Energy Use (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	111	171	154	153	146	149	60	69	128	153	133	106
20%	95	150	149	131	133	138	43	46	103	139	122	105
30%	85	139	142	118	115	109	37	41	88	122	114	103
40%	76	129	134	113	99	98	35	39	78	114	109	96
50%	72	105	129	110	94	75	32	36	65	104	102	87
60%	67	93	123	105	85	65	31	33	58	93	94	76
70%	62	81	115	95	72	61	29	30	44	84	79	68
80%	57	65	96	83	47	46	25	26	34	69	59	58
90%	54	58	74	71	31	22	21	21	21	42	36	45
Long Term												
Full Simulation Period ^b	76	111	121	108	92	86	36	40	71	101	93	82
Water Year Types^c												
Wet (32%)	81	125	130	124	125	122	50	58	113	132	119	94
Above Normal (16%)	74	120	123	97	91	104	36	40	85	99	108	87
Below Normal (13%)	79	122	132	107	84	76	30	33	61	106	106	92
Dry (24%)	76	103	120	108	77	64	30	30	42	90	65	72
Critical (15%)	65	73	89	85	52	31	21	22	22	51	56	57

No Action Alternative minus Revised Second Basis of Comparison

Statistic	Monthly Energy Use (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-19%	13%	-5%	-12%	-23%	2%	-28%	-24%	12%	-6%	-26%	-3%
20%	-21%	7%	-6%	-21%	-10%	8%	-47%	-29%	-1%	-11%	-20%	-2%
30%	-28%	1%	-10%	-28%	-19%	6%	-53%	-31%	-8%	-18%	-14%	-3%
40%	-21%	-2%	-13%	-30%	-28%	21%	-54%	-27%	-14%	-19%	-15%	-9%
50%	-3%	-14%	-15%	-31%	-30%	9%	-53%	-23%	-25%	-21%	-17%	-17%
60%	3%	-14%	-14%	-33%	-14%	-2%	-51%	-25%	-25%	-21%	-15%	-15%
70%	14%	-15%	-10%	-35%	-7%	-2%	-41%	-21%	-30%	-13%	-7%	-18%
80%	30%	-15%	-19%	-33%	-3%	-11%	-30%	-7%	-22%	-20%	9%	-14%
90%	72%	-12%	-14%	-5%	25%	-21%	-2%	-6%	-17%	0%	-7%	-8%
Long Term												
Full Simulation Period ^b	-9%	-3%	-12%	-27%	-20%	1%	-41%	-20%	-8%	-15%	-17%	-11%
Water Year Types^c												
Wet (32%)	-17%	-5%	-16%	-26%	-9%	27%	-37%	-15%	11%	-9%	-20%	-14%
Above Normal (16%)	1%	4%	-10%	-34%	-32%	12%	-54%	-29%	-15%	-23%	-20%	-24%
Below Normal (13%)	-15%	-10%	-11%	-32%	-15%	-10%	-51%	-34%	-26%	-28%	-24%	-1%
Dry (24%)	-11%	3%	-4%	-22%	-25%	-24%	-30%	-17%	-23%	-15%	-3%	-4%
Critical (15%)	25%	-4%	-16%	-21%	-34%	-39%	-32%	-7%	-25%	14%	-8%	-3%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.2.18.3 CVP Total Energy Use, Monthly Energy Use

Revised Second Basis of Comparison

Statistic	Monthly Energy Use (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	137	152	163	173	189	145	83	90	114	163	178	109
20%	121	140	159	167	148	128	81	64	103	156	153	108
30%	118	139	157	163	142	103	80	59	96	148	132	107
40%	96	131	155	162	138	82	75	53	91	140	128	106
50%	74	123	152	160	135	68	69	46	87	131	123	105
60%	65	108	143	157	99	67	63	43	78	117	110	90
70%	54	96	128	147	77	62	49	38	64	97	85	83
80%	44	77	119	123	48	52	36	28	43	86	54	68
90%	32	67	86	74	25	28	22	23	25	42	39	49
Long Term												
Full Simulation Period ^b	84	114	136	148	114	84	61	50	77	118	113	92
Water Year Types^c												
Wet (32%)	99	131	154	168	137	96	79	69	102	145	149	109
Above Normal (16%)	73	115	136	148	133	93	79	57	100	129	135	115
Below Normal (13%)	93	135	149	157	99	85	61	51	83	147	139	93
Dry (24%)	86	101	125	139	103	84	43	36	55	105	67	75
Critical (15%)	52	76	106	109	78	50	30	24	30	45	61	58

Alternative 3

Statistic	Monthly Energy Use (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	143	149	161	165	151	147	87	99	142	154	156	139
20%	124	140	157	131	142	139	82	89	122	146	134	112
30%	119	138	154	120	126	100	81	79	106	139	132	107
40%	108	128	143	117	105	78	79	72	100	128	128	106
50%	86	118	140	110	91	72	72	66	91	118	113	105
60%	70	107	131	104	75	64	64	53	80	103	99	95
70%	63	95	122	93	65	62	46	40	59	87	83	85
80%	52	82	102	84	54	51	35	30	41	71	62	63
90%	46	66	73	76	31	24	23	23	24	46	41	45
Long Term												
Full Simulation Period ^b	91	113	129	109	95	85	62	62	85	109	106	97
Water Year Types^c												
Wet (32%)	101	130	144	128	135	108	83	87	125	139	140	113
Above Normal (16%)	83	113	122	93	96	125	77	74	105	115	121	111
Below Normal (13%)	94	130	144	111	85	78	56	58	86	123	117	126
Dry (24%)	97	104	126	108	75	65	49	44	54	98	75	74
Critical (15%)	64	78	97	85	53	31	30	25	27	43	55	58

Alternative 3 minus Revised Second Basis of Comparison

Statistic	Monthly Energy Use (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4%	-2%	-1%	-5%	-20%	1%	5%	11%	24%	-5%	-12%	27%
20%	2%	0%	-1%	-21%	-4%	9%	1%	38%	18%	-6%	-13%	4%
30%	1%	0%	-2%	-27%	-11%	-2%	2%	34%	11%	-6%	0%	1%
40%	12%	-3%	-8%	-27%	-24%	-4%	5%	35%	10%	-9%	0%	0%
50%	16%	-4%	-8%	-31%	-32%	5%	4%	43%	4%	-10%	-8%	0%
60%	8%	-1%	-8%	-34%	-24%	-4%	1%	22%	3%	-12%	-10%	6%
70%	16%	-1%	-4%	-37%	-16%	0%	-5%	4%	-8%	-10%	-2%	3%
80%	18%	8%	-15%	-31%	12%	-2%	-2%	8%	-5%	-18%	15%	-7%
90%	45%	-1%	-16%	2%	21%	-17%	8%	2%	-5%	11%	7%	-7%
Long Term												
Full Simulation Period ^b	8%	0%	-5%	-26%	-17%	1%	2%	23%	10%	-8%	-6%	5%
Water Year Types^c												
Wet (32%)	3%	-1%	-7%	-24%	-2%	12%	5%	27%	23%	-4%	-6%	4%
Above Normal (16%)	13%	-2%	-10%	-37%	-27%	34%	-3%	30%	5%	-11%	-10%	-4%
Below Normal (13%)	1%	-4%	-3%	-29%	-14%	-8%	-9%	15%	4%	-16%	-16%	36%
Dry (24%)	13%	3%	1%	-22%	-27%	13%	20%	20%	-2%	-7%	12%	-1%
Critical (15%)	22%	2%	-8%	-21%	-33%	-39%	-1%	5%	-10%	-4%	-9%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.2.18.4 CVP Total Energy Use, Monthly Energy Use

Revised Second Basis of Comparison

Statistic	Monthly Energy Use (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	137	152	163	173	189	145	83	90	114	163	178	109
20%	121	140	159	167	148	128	81	64	103	156	153	108
30%	118	139	157	163	142	103	80	59	96	148	132	107
40%	96	131	155	162	138	82	75	53	91	140	128	106
50%	74	123	152	160	135	68	69	46	87	131	123	105
60%	65	108	143	157	99	67	63	43	78	117	110	90
70%	54	96	128	147	77	62	49	38	64	97	85	83
80%	44	77	119	123	48	52	36	28	43	86	54	68
90%	32	67	86	74	25	28	22	23	25	42	39	49
Long Term												
Full Simulation Period ^b	84	114	136	148	114	84	61	50	77	118	113	92
Water Year Types^c												
Wet (32%)	99	131	154	168	137	96	79	69	102	145	149	109
Above Normal (16%)	73	115	136	148	133	93	79	57	100	129	135	115
Below Normal (13%)	93	135	149	157	99	85	61	51	83	147	139	93
Dry (24%)	86	101	125	139	103	84	43	36	55	105	67	75
Critical (15%)	52	76	106	109	78	50	30	24	30	45	61	58

Alternative 5

Statistic	Monthly Energy Use (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	106	174	154	153	146	153	59	68	128	155	132	106
20%	94	153	151	134	134	138	41	44	103	140	121	105
30%	85	140	142	120	116	109	35	40	86	122	113	102
40%	75	126	135	114	104	99	32	37	77	115	110	95
50%	72	106	128	110	94	75	30	33	65	105	102	90
60%	69	92	123	104	86	65	29	30	57	94	94	76
70%	63	74	115	95	71	61	24	22	46	88	80	70
80%	59	65	92	83	46	48	18	16	32	74	63	58
90%	54	56	68	71	32	22	13	12	24	50	49	47
Long Term												
Full Simulation Period ^b	76	110	121	109	92	86	33	36	71	103	95	82
Water Year Types^c												
Wet (32%)	81	129	131	125	124	123	50	58	113	132	119	93
Above Normal (16%)	75	112	122	100	90	104	35	40	84	100	107	86
Below Normal (13%)	76	122	132	107	90	77	28	30	62	106	100	96
Dry (24%)	74	101	121	108	77	64	23	21	43	96	71	74
Critical (15%)	69	73	86	88	54	30	13	13	22	56	64	56

Alternative 5 minus Revised Second Basis of Comparison

Statistic	Monthly Energy Use (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-23%	14%	-5%	-12%	-23%	5%	-29%	-25%	12%	-5%	-26%	-3%
20%	-22%	9%	-5%	-20%	-10%	8%	-49%	-31%	0%	-10%	-21%	-2%
30%	-28%	1%	-10%	-27%	-18%	6%	-56%	-32%	-10%	-17%	-15%	-4%
40%	-22%	-4%	-13%	-30%	-25%	21%	-57%	-31%	-16%	-18%	-14%	-10%
50%	-2%	-14%	-16%	-31%	-30%	9%	-57%	-29%	-25%	-20%	-17%	-14%
60%	7%	-15%	-14%	-34%	-13%	-2%	-55%	-32%	-26%	-20%	-15%	-15%
70%	16%	-22%	-10%	-35%	-8%	-2%	-52%	-42%	-28%	-9%	-5%	-16%
80%	33%	-16%	-23%	-33%	-4%	-8%	-49%	-42%	-26%	-15%	16%	-15%
90%	70%	-16%	-21%	-4%	27%	-22%	-40%	-48%	-6%	20%	27%	-4%
Long Term												
Full Simulation Period ^b	-10%	-3%	-12%	-26%	-19%	2%	-47%	-28%	-8%	-13%	-16%	-11%
Water Year Types^c												
Wet (32%)	-18%	-2%	-16%	-26%	-10%	27%	-37%	-15%	10%	-9%	-20%	-15%
Above Normal (16%)	3%	-3%	-10%	-32%	-32%	12%	-56%	-31%	-16%	-23%	-21%	-25%
Below Normal (13%)	-18%	-10%	-11%	-32%	-9%	-9%	-54%	-42%	-25%	-28%	-28%	3%
Dry (24%)	-14%	0%	-3%	-22%	-25%	-24%	-47%	-41%	-21%	-9%	6%	-2%
Critical (15%)	31%	-4%	-18%	-19%	-31%	-39%	-57%	-44%	-25%	24%	5%	-4%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

5C.3.2.19 CVP Net Energy Use

Table 5C.3.2.19.1 CVP Net Generation, Monthly Net Generation

No Action Alternative

Statistic	Monthly Net Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	324	257	523	556	567	564	449	560	543	664	474	528
20%	283	220	218	372	491	444	355	513	500	624	446	491
30%	249	195	116	257	358	262	325	468	476	596	427	366
40%	216	162	72	147	163	169	304	441	452	558	418	344
50%	200	112	49	104	110	150	285	424	438	537	405	246
60%	154	96	42	71	94	133	270	404	426	508	381	198
70%	134	71	30	50	71	109	248	383	410	480	366	183
80%	119	56	18	37	54	95	225	327	377	450	347	150
90%	86	40	-1	24	36	72	198	262	332	400	302	104
Long Term												
Full Simulation Period ^b	197	145	139	209	230	243	307	420	443	530	393	295
Water Year Types^c												
Wet (32%)	236	193	311	433	389	435	397	522	455	551	423	504
Above Normal (16%)	193	143	136	223	363	263	334	443	459	608	419	334
Below Normal (13%)	231	137	43	79	181	144	288	422	478	573	423	198
Dry (24%)	178	128	34	74	67	119	233	376	469	518	391	174
Critical (15%)	118	76	34	48	59	104	221	249	323	380	276	89

Revised Alternative 1

Statistic	Monthly Net Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	284	162	524	558	598	565	406	564	602	639	479	291
20%	242	130	268	409	492	482	323	519	571	620	466	257
30%	197	106	114	286	291	296	292	481	531	602	441	228
40%	172	88	75	135	201	194	272	463	503	585	423	217
50%	164	81	46	72	113	155	255	436	482	549	408	203
60%	154	74	32	37	81	129	236	407	465	524	395	191
70%	141	61	21	19	58	106	215	386	452	497	372	181
80%	115	51	9	11	24	83	199	340	410	463	358	156
90%	97	33	-13	-10	-6	63	170	288	366	399	319	103
Long Term												
Full Simulation Period ^b	173	102	142	187	220	251	277	431	489	540	404	215
Water Year Types^c												
Wet (32%)	198	138	337	413	394	455	351	519	522	555	428	293
Above Normal (16%)	167	99	110	211	348	305	266	454	515	612	437	225
Below Normal (13%)	192	85	37	70	183	160	265	440	529	577	438	210
Dry (24%)	162	82	34	39	46	95	223	393	488	534	395	177
Critical (15%)	129	72	28	25	30	91	227	273	356	407	301	103

Revised Alternative 1 minus No Action Alternative

Statistic	Monthly Net Generation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-12%	-37%	0%	0%	5%	0%	-10%	1%	11%	-4%	1%	-45%
20%	-14%	-41%	23%	10%	0%	9%	-9%	1%	14%	-1%	5%	-48%
30%	-21%	-45%	-2%	11%	-19%	13%	-10%	3%	11%	1%	3%	-38%
40%	-20%	-45%	4%	-8%	24%	15%	-11%	5%	11%	5%	1%	-37%
50%	-18%	-28%	-6%	-31%	3%	3%	-10%	3%	10%	2%	1%	-18%
60%	0%	-23%	-24%	-48%	-14%	-3%	-13%	1%	9%	3%	4%	-4%
70%	5%	-14%	-30%	-62%	-18%	-3%	-13%	1%	10%	4%	2%	-1%
80%	-4%	-8%	-47%	-72%	-56%	-13%	-12%	4%	9%	3%	3%	4%
90%	13%	-18%	1847%	-141%	-117%	-14%	-14%	10%	10%	0%	6%	-1%
Long Term												
Full Simulation Period ^b	-12%	-30%	2%	-10%	-4%	3%	-10%	3%	10%	2%	3%	-27%
Water Year Types^c												
Wet (32%)	-16%	-29%	8%	-5%	1%	5%	-12%	-1%	15%	1%	1%	-42%
Above Normal (16%)	-13%	-31%	-20%	-5%	-4%	16%	-20%	2%	12%	1%	4%	-33%
Below Normal (13%)	-17%	-37%	-13%	-12%	1%	11%	-8%	4%	11%	1%	4%	6%
Dry (24%)	-9%	-36%	-1%	-48%	-31%	-20%	-4%	4%	3%	1%	2%	2%
Critical (15%)	9%	-5%	-16%	-49%	-49%	-13%	3%	10%	10%	7%	9%	16%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.2.19.2 CVP Net Generation, Monthly Net Generation

Revised Second Basis of Comparison

Statistic	Monthly Net Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	284	162	524	558	598	565	406	564	602	639	479	291
20%	242	130	268	409	492	482	323	519	571	620	466	257
30%	197	106	114	286	291	296	292	481	531	602	441	228
40%	172	88	75	135	201	194	272	463	503	585	423	217
50%	164	81	46	72	113	155	255	436	482	549	408	203
60%	154	74	32	37	81	129	236	407	465	524	395	191
70%	141	61	21	19	58	106	215	386	452	497	372	181
80%	115	51	9	11	24	83	199	340	410	463	358	156
90%	97	33	-13	-10	-6	63	170	288	366	399	319	103
Long Term												
Full Simulation Period ^b	173	102	142	187	220	251	277	431	489	540	404	215
Water Year Types^c												
Wet (32%)	198	138	337	413	394	455	351	519	522	555	428	293
Above Normal (16%)	167	99	110	211	348	305	266	454	515	612	437	225
Below Normal (13%)	192	85	37	70	183	160	265	440	529	577	438	210
Dry (24%)	162	82	34	39	46	95	223	393	488	534	395	177
Critical (15%)	129	72	28	25	30	91	227	273	356	407	301	103

No Action Alternative

Statistic	Monthly Net Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	324	257	523	556	567	564	449	560	543	664	474	528
20%	283	220	218	372	491	444	355	513	500	624	446	491
30%	249	195	116	257	358	262	325	468	476	596	427	366
40%	216	162	72	147	163	169	304	441	452	558	418	344
50%	200	112	49	104	110	150	285	424	438	537	405	246
60%	154	96	42	71	94	133	270	404	426	508	381	198
70%	134	71	30	50	71	109	248	383	410	480	366	183
80%	119	56	18	37	54	95	225	327	377	450	347	150
90%	86	40	-1	24	36	72	198	262	332	400	302	104
Long Term												
Full Simulation Period ^b	197	145	139	209	230	243	307	420	443	530	393	295
Water Year Types^c												
Wet (32%)	236	193	311	433	389	435	397	522	455	551	423	504
Above Normal (16%)	193	143	136	223	363	263	334	443	459	608	419	334
Below Normal (13%)	231	137	43	79	181	144	288	422	478	573	423	198
Dry (24%)	178	128	34	74	67	119	233	376	469	518	391	174
Critical (15%)	118	76	34	48	59	104	221	249	323	380	276	89

No Action Alternative minus Revised Second Basis of Comparison

Statistic	Monthly Net Generation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	14%	59%	0%	0%	-5%	0%	11%	-1%	-10%	4%	-1%	81%
20%	17%	69%	-19%	-9%	0%	-8%	10%	-1%	-12%	1%	-4%	91%
30%	26%	83%	2%	-10%	23%	-11%	11%	-3%	-10%	-1%	-3%	61%
40%	26%	83%	-4%	8%	-19%	-13%	12%	-5%	-10%	-5%	-1%	59%
50%	22%	38%	7%	45%	-3%	-3%	12%	-3%	-9%	-2%	-1%	21%
60%	0%	30%	31%	91%	16%	3%	14%	-1%	-8%	-3%	-3%	4%
70%	-5%	16%	43%	162%	22%	3%	16%	-1%	-9%	-3%	-2%	1%
80%	4%	9%	89%	254%	130%	15%	13%	-4%	-8%	-3%	-3%	-4%
90%	-11%	21%	-95%	-341%	-681%	16%	16%	-9%	-9%	0%	-5%	1%
Long Term												
Full Simulation Period ^b	14%	42%	-2%	12%	4%	-3%	11%	-2%	-9%	-2%	-3%	37%
Water Year Types^c												
Wet (32%)	19%	40%	-8%	5%	-1%	-4%	13%	1%	-13%	-1%	-1%	72%
Above Normal (16%)	15%	44%	24%	6%	4%	-14%	26%	-2%	-11%	-1%	-4%	49%
Below Normal (13%)	20%	60%	15%	14%	-1%	-10%	9%	-4%	-10%	-1%	-3%	-6%
Dry (24%)	10%	56%	1%	93%	45%	25%	4%	-4%	-4%	-1%	-1%	-2%
Critical (15%)	-8%	5%	20%	96%	95%	14%	-3%	-9%	-9%	-7%	-8%	-14%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.2.19.3 CVP Net Generation, Monthly Net Generation

Revised Second Basis of Comparison

Statistic	Monthly Net Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	284	162	524	558	598	565	406	564	602	639	479	291
20%	242	130	268	409	492	482	323	519	571	620	466	257
30%	197	106	114	286	291	296	292	481	531	602	441	228
40%	172	88	75	135	201	194	272	463	503	585	423	217
50%	164	81	46	72	113	155	255	436	482	549	408	203
60%	154	74	32	37	81	129	236	407	465	524	395	191
70%	141	61	21	19	58	106	215	386	452	497	372	181
80%	115	51	9	11	24	83	199	340	410	463	358	156
90%	97	33	-13	-10	-6	63	170	288	366	399	319	103
Long Term												
Full Simulation Period ^b	173	102	142	187	220	251	277	431	489	540	404	215
Water Year Types^c												
Wet (32%)	198	138	337	413	394	455	351	519	522	555	428	293
Above Normal (16%)	167	99	110	211	348	305	266	454	515	612	437	225
Below Normal (13%)	192	85	37	70	183	160	265	440	529	577	438	210
Dry (24%)	162	82	34	39	46	95	223	393	488	534	395	177
Critical (15%)	129	72	28	25	30	91	227	273	356	407	301	103

Alternative 3

Statistic	Monthly Net Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	291	182	530	558	606	583	437	534	563	674	481	336
20%	235	125	266	480	511	511	316	479	531	638	465	266
30%	193	104	114	332	334	287	298	459	508	622	441	246
40%	173	91	74	160	183	189	268	439	473	596	424	216
50%	158	77	52	112	122	150	251	392	448	544	409	205
60%	147	66	39	72	84	122	229	374	433	528	387	195
70%	133	60	25	51	71	106	216	348	411	506	374	181
80%	113	52	12	36	56	92	200	316	387	469	362	155
90%	88	31	-6	18	41	71	174	260	340	397	326	104
Long Term												
Full Simulation Period ^b	172	102	150	224	241	250	275	400	457	549	406	217
Water Year Types^c												
Wet (32%)	197	137	349	456	402	443	347	475	467	572	436	294
Above Normal (16%)	166	109	123	257	381	276	269	408	475	621	429	230
Below Normal (13%)	190	81	42	117	198	167	276	418	493	588	440	221
Dry (24%)	160	81	36	67	71	115	217	372	478	537	396	177
Critical (15%)	125	73	35	45	60	108	223	260	346	402	305	101

Alternative 3 minus Revised Second Basis of Comparison

Statistic	Monthly Net Generation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2%	13%	1%	0%	1%	3%	8%	-5%	-6%	5%	0%	15%
20%	-3%	-4%	-1%	17%	4%	6%	-2%	-8%	-7%	3%	0%	3%
30%	-2%	-2%	0%	16%	15%	-3%	2%	-4%	-4%	3%	0%	8%
40%	1%	3%	-2%	18%	-9%	-2%	-1%	-5%	-6%	2%	0%	-1%
50%	-4%	-4%	12%	56%	8%	-3%	-2%	-10%	-7%	-1%	0%	1%
60%	-5%	-11%	20%	94%	3%	-5%	-3%	-8%	-7%	1%	-2%	2%
70%	-6%	-2%	19%	166%	23%	-1%	1%	-10%	-9%	2%	1%	0%
80%	-2%	1%	23%	241%	136%	11%	0%	-7%	-6%	1%	1%	0%
90%	-9%	-5%	-57%	-278%	-768%	14%	3%	-10%	-7%	-1%	2%	1%
Long Term												
Full Simulation Period ^b	-1%	0%	6%	20%	9%	0%	-1%	-7%	-7%	2%	1%	1%
Water Year Types^c												
Wet (32%)	0%	0%	4%	11%	2%	-3%	-1%	-8%	-10%	3%	2%	0%
Above Normal (16%)	-1%	10%	12%	22%	9%	-10%	1%	-10%	-8%	2%	-2%	3%
Below Normal (13%)	-1%	-5%	14%	68%	8%	4%	4%	-5%	-7%	2%	0%	5%
Dry (24%)	-2%	-2%	7%	74%	53%	21%	-3%	-5%	-2%	1%	0%	0%
Critical (15%)	-3%	0%	22%	83%	97%	19%	-2%	-5%	-3%	-1%	1%	-2%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.2.19.4 CVP Net Generation, Monthly Net Generation

Revised Second Basis of Comparison

Statistic	Monthly Net Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	284	162	524	558	598	565	406	564	602	639	479	291
20%	242	130	268	409	492	482	323	519	571	620	466	257
30%	197	106	114	286	291	296	292	481	531	602	441	228
40%	172	88	75	135	201	194	272	463	503	585	423	217
50%	164	81	46	72	113	155	255	436	482	549	408	203
60%	154	74	32	37	81	129	236	407	465	524	395	191
70%	141	61	21	19	58	106	215	386	452	497	372	181
80%	115	51	9	11	24	83	199	340	410	463	358	156
90%	97	33	-13	-10	-6	63	170	288	366	399	319	103
Long Term												
Full Simulation Period ^b	173	102	142	187	220	251	277	431	489	540	404	215
Water Year Types^c												
Wet (32%)	198	138	337	413	394	455	351	519	522	555	428	293
Above Normal (16%)	167	99	110	211	348	305	266	454	515	612	437	225
Below Normal (13%)	192	85	37	70	183	160	265	440	529	577	438	210
Dry (24%)	162	82	34	39	46	95	223	393	488	534	395	177
Critical (15%)	129	72	28	25	30	91	227	273	356	407	301	103

Alternative 5

Statistic	Monthly Net Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	323	255	511	557	567	559	451	559	528	654	468	527
20%	285	219	219	356	495	444	360	514	496	620	442	495
30%	233	186	113	253	363	270	330	469	475	589	426	365
40%	217	160	72	146	159	168	310	447	450	551	415	343
50%	194	116	48	104	107	148	294	426	437	531	402	243
60%	158	99	39	72	92	131	274	409	424	509	377	199
70%	134	71	28	52	67	105	254	389	404	485	366	177
80%	110	57	18	38	52	84	237	323	368	425	346	146
90%	84	31	-2	25	35	72	210	288	322	396	304	107
Long Term												
Full Simulation Period ^b	197	144	137	208	229	242	315	427	438	524	390	296
Water Year Types^c												
Wet (32%)	233	191	307	433	388	431	397	527	454	553	419	506
Above Normal (16%)	190	142	136	221	364	264	335	449	458	608	416	333
Below Normal (13%)	230	135	42	79	175	144	305	428	471	569	420	198
Dry (24%)	179	130	32	75	67	119	250	383	461	508	388	173
Critical (15%)	123	76	34	47	56	102	237	257	314	358	273	97

Alternative 5 minus Revised Second Basis of Comparison

Statistic	Monthly Net Generation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	14%	58%	-2%	0%	-5%	-1%	11%	-1%	-12%	2%	-2%	81%
20%	18%	68%	-18%	-13%	1%	-8%	11%	-1%	-13%	0%	-5%	92%
30%	18%	74%	0%	-12%	25%	-9%	13%	-2%	-10%	-2%	-4%	60%
40%	26%	80%	-5%	8%	-21%	-14%	14%	-3%	-10%	-6%	-2%	58%
50%	18%	44%	3%	44%	-6%	-5%	15%	-2%	-9%	-3%	-1%	20%
60%	2%	33%	21%	94%	13%	2%	16%	1%	-9%	-3%	-5%	4%
70%	-5%	16%	31%	167%	15%	-1%	18%	1%	-11%	-2%	-2%	-2%
80%	-5%	11%	88%	259%	122%	1%	19%	-5%	-10%	-8%	-3%	-6%
90%	-13%	-6%	-86%	-350%	-678%	15%	24%	0%	-12%	-1%	-5%	4%
Long Term												
Full Simulation Period ^b	13%	42%	-3%	12%	4%	-4%	14%	-1%	-10%	-3%	-4%	38%
Water Year Types^c												
Wet (32%)	18%	39%	-9%	5%	-1%	-5%	13%	1%	-13%	0%	-2%	73%
Above Normal (16%)	14%	43%	24%	5%	4%	-14%	26%	-1%	-11%	-1%	-5%	48%
Below Normal (13%)	20%	58%	12%	13%	-5%	-10%	15%	-3%	-11%	-1%	-4%	-6%
Dry (24%)	11%	58%	-5%	95%	45%	25%	12%	-3%	-6%	-5%	-2%	-2%
Critical (15%)	-5%	6%	19%	91%	84%	12%	4%	-6%	-12%	-12%	-9%	-6%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

5C.3.2.20 Stanislaus River Percent Mortality – Fall-run Chinook Salmon

Table 5C.3.2.20 Stanislaus River Percent Mortality - Fall-Run Chinook Salmon

	Percent Mortality	Difference from No Action Alternative	Difference from Second Basis of Comparison
	%	%	%
No Action Alternative			
Long-term Average	7.0	---	0.4
Wet	1.6	---	0.1
Above Normal	5.3	---	1.1
Below Normal	4.4	---	0.5
Dry	4.9	---	-0.3
Critical	14.4	---	0.4
Second Basis of Comparison			
Long-term Average	6.6	-0.4	
Wet	1.5	-0.1	---
Above Normal	4.3	-1.1	---
Below Normal	4.0	-0.5	---
Dry	5.1	0.3	---
Critical	14.0	-0.4	---
Alternative 3			
Long-term Average	6.2	-0.8	-0.4
Wet	1.6	0.0	0.1
Above Normal	4.0	-1.3	-0.3
Below Normal	3.8	-0.6	-0.2
Dry	4.2	-0.7	-0.9
Critical	13.4	-1.0	-0.6
Alternative 5			
Long-term Average	8.5	1.5	1.9
Wet	1.8	0.2	0.3
Above Normal	6.4	1.1	2.1
Below Normal	6.1	1.6	2.1
Dry	7.0	2.2	1.9
Critical	16.9	2.5	2.9

Notes: All results are based on the 82-year simulation period. The water year types are defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

5C.3.2.21 New Melones Large Mouth Bass Nest Survival Percentage

Table 5C.3.2.21.1 New Melones Large Mouth Bass Nest Survival Percentage, Monthly Percentage

No Action Alternative

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	66	38	80
20%	100	100	100	100	100	100	100	100	100	49	30	64
30%	84	100	100	100	100	100	100	100	100	31	25	59
40%	74	100	100	100	100	100	100	100	100	25	23	57
50%	67	100	100	100	100	100	80	100	98	22	20	55
60%	59	100	100	100	100	100	72	100	63	18	19	50
70%	50	100	100	100	100	100	49	40	42	13	16	43
80%	43	100	100	100	100	100	27	29	27	10	12	38
90%	29	100	100	100	100	100	13	14	15	1	4	34
Long Term												
Full Simulation Period ^b	66	99	100	100	97	95	68	72	69	29	23	54
Water Year Types^c												
Wet (23%)	67	100	100	100	96	94	83	98	95	47	24	51
Above Normal (24%)	74	100	100	100	100	100	88	100	72	26	20	60
Below Normal (10%)	60	100	100	100	98	95	58	65	61	22	19	58
Dry (16%)	63	99	100	100	97	98	66	51	54	14	16	49
Critical (27%)	65	97	100	100	93	87	29	25	43	28	37	58

Revised Alternative 1

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	53	33	74
20%	100	100	100	100	100	100	100	100	100	38	30	65
30%	100	100	100	100	100	100	100	100	100	31	29	59
40%	100	100	100	100	100	100	100	100	100	27	26	57
50%	100	100	100	100	100	100	100	100	93	24	23	54
60%	100	100	100	100	100	100	86	100	63	22	21	51
70%	100	100	100	100	100	100	69	53	44	19	17	47
80%	97	100	100	100	100	100	49	43	31	16	11	39
90%	90	100	100	100	100	100	36	24	21	12	7	23
Long Term												
Full Simulation Period ^b	97	100	100	100	97	97	79	76	71	29	22	54
Water Year Types^c												
Wet (23%)	99	100	100	100	96	97	91	98	96	41	22	47
Above Normal (24%)	96	99	100	100	100	100	93	100	72	29	23	61
Below Normal (10%)	96	100	100	100	98	100	74	73	65	25	22	57
Dry (16%)	96	99	100	100	96	98	81	60	58	20	21	53
Critical (27%)	99	100	100	100	96	87	42	34	40	19	20	57

Revised Alternative 1 minus No Action Alternative

Statistic	Monthly Percentage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-20%	-13%	-8%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-24%	2%	1%
30%	19%	0%	0%	0%	0%	0%	0%	0%	0%	0%	15%	0%
40%	35%	0%	0%	0%	0%	0%	0%	0%	0%	6%	16%	0%
50%	48%	0%	0%	0%	0%	0%	26%	0%	-5%	5%	13%	0%
60%	70%	0%	0%	0%	0%	0%	20%	0%	-1%	19%	11%	3%
70%	99%	0%	0%	0%	0%	0%	41%	32%	7%	50%	2%	8%
80%	126%	0%	0%	0%	0%	0%	85%	48%	12%	62%	-4%	2%
90%	215%	0%	0%	0%	0%	0%	183%	75%	42%	888%	93%	-32%
Long Term												
Full Simulation Period ^b	48%	0%	0%	0%	0%	2%	17%	7%	2%	-3%	-4%	-1%
Water Year Types^c												
Wet (23%)	49%	0%	0%	0%	0%	4%	10%	0%	2%	-14%	-7%	-8%
Above Normal (24%)	31%	0%	0%	0%	0%	0%	6%	0%	0%	13%	16%	1%
Below Normal (10%)	59%	0%	0%	0%	0%	5%	28%	12%	6%	11%	16%	0%
Dry (16%)	51%	0%	0%	0%	0%	0%	22%	18%	7%	48%	29%	8%
Critical (27%)	53%	3%	0%	0%	3%	0%	47%	34%	-7%	-32%	-45%	-1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.21.2 New Melones Large Mouth Bass Nest Survival Percentage, Monthly Percentage

Revised Second Basis of Comparison

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	53	33	74
20%	100	100	100	100	100	100	100	100	100	38	30	65
30%	100	100	100	100	100	100	100	100	100	31	29	59
40%	100	100	100	100	100	100	100	100	100	27	26	57
50%	100	100	100	100	100	100	100	100	93	24	23	54
60%	100	100	100	100	100	100	86	100	63	22	21	51
70%	100	100	100	100	100	100	69	53	44	19	17	47
80%	97	100	100	100	100	100	49	43	31	16	11	39
90%	90	100	100	100	100	100	36	24	21	12	7	23
Long Term												
Full Simulation Period ^b	97	100	100	100	97	97	79	76	71	29	22	54
Water Year Types^c												
Wet (23%)	99	100	100	100	96	97	91	98	96	41	22	47
Above Normal (24%)	96	99	100	100	100	100	93	100	72	29	23	61
Below Normal (10%)	96	100	100	100	98	100	74	73	65	25	22	57
Dry (16%)	96	99	100	100	96	98	81	60	58	20	21	53
Critical (27%)	99	100	100	100	96	87	42	34	40	19	20	57

No Action Alternative

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	66	38	80
20%	100	100	100	100	100	100	100	100	100	49	30	64
30%	84	100	100	100	100	100	100	100	100	31	25	59
40%	74	100	100	100	100	100	100	100	100	25	23	57
50%	67	100	100	100	100	100	80	100	98	22	20	55
60%	59	100	100	100	100	100	72	100	63	18	19	50
70%	50	100	100	100	100	100	49	40	42	13	16	43
80%	43	100	100	100	100	100	27	29	27	10	12	38
90%	29	100	100	100	100	100	13	14	15	1	4	34
Long Term												
Full Simulation Period ^b	66	99	100	100	97	95	68	72	69	29	23	54
Water Year Types^c												
Wet (23%)	67	100	100	100	96	94	83	98	95	47	24	51
Above Normal (24%)	74	100	100	100	100	100	88	100	72	26	20	60
Below Normal (10%)	60	100	100	100	98	95	58	65	61	22	19	58
Dry (16%)	63	99	100	100	97	98	66	51	54	14	16	49
Critical (27%)	65	97	100	100	93	87	29	25	43	28	37	58

No Action Alternative minus Revised Second Basis of Comparison

Statistic	Monthly Percentage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	25%	15%	8%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	32%	-2%	-1%
30%	-16%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-13%	0%
40%	-26%	0%	0%	0%	0%	0%	0%	0%	0%	-6%	-14%	0%
50%	-33%	0%	0%	0%	0%	0%	-20%	0%	5%	-5%	-12%	0%
60%	-41%	0%	0%	0%	0%	0%	-17%	0%	1%	-16%	-10%	-3%
70%	-50%	0%	0%	0%	0%	0%	-29%	-24%	-6%	-33%	-2%	-7%
80%	-56%	0%	0%	0%	0%	0%	-46%	-32%	-11%	-38%	5%	-2%
90%	-68%	0%	0%	0%	0%	0%	-65%	-43%	-30%	-90%	-48%	47%
Long Term												
Full Simulation Period ^b	-32%	0%	0%	0%	0%	-2%	-14%	-6%	-2%	3%	4%	1%
Water Year Types^c												
Wet (23%)	-33%	0%	0%	0%	0%	-3%	-9%	0%	-2%	16%	8%	9%
Above Normal (24%)	-23%	0%	0%	0%	0%	0%	-6%	0%	0%	-12%	-13%	-1%
Below Normal (10%)	-37%	0%	0%	0%	0%	-5%	-22%	-11%	-6%	-10%	-14%	0%
Dry (16%)	-34%	0%	0%	0%	0%	0%	-18%	-16%	-7%	-32%	-22%	-7%
Critical (27%)	-35%	-3%	0%	0%	-3%	0%	-32%	-25%	7%	46%	81%	1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.21.3 New Melones Large Mouth Bass Nest Survival Percentage, Monthly Percentage

Revised Second Basis of Comparison

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	53	33	74
20%	100	100	100	100	100	100	100	100	100	38	30	65
30%	100	100	100	100	100	100	100	100	100	31	29	59
40%	100	100	100	100	100	100	100	100	100	27	26	57
50%	100	100	100	100	100	100	100	100	93	24	23	54
60%	100	100	100	100	100	100	86	100	63	22	21	51
70%	100	100	100	100	100	100	69	53	44	19	17	47
80%	97	100	100	100	100	100	49	43	31	16	11	39
90%	90	100	100	100	100	100	36	24	21	12	7	23
Long Term												
Full Simulation Period ^b	97	100	100	100	97	97	79	76	71	29	22	54
Water Year Types^c												
Wet (23%)	99	100	100	100	96	97	91	98	96	41	22	47
Above Normal (24%)	96	99	100	100	100	100	93	100	72	29	23	61
Below Normal (10%)	96	100	100	100	98	100	74	73	65	25	22	57
Dry (16%)	96	99	100	100	96	98	81	60	58	20	21	53
Critical (27%)	99	100	100	100	96	87	42	34	40	19	20	57

Alternative 3

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	100	43	78
20%	100	100	100	100	100	100	100	100	100	57	37	69
30%	100	100	100	100	100	100	100	100	100	43	29	61
40%	100	100	100	100	100	100	100	100	100	31	27	56
50%	100	100	100	100	100	100	97	100	100	24	23	55
60%	100	100	100	100	100	100	75	92	55	21	20	48
70%	100	100	100	100	100	100	57	44	35	18	18	42
80%	94	100	100	100	100	100	43	21	28	11	11	31
90%	84	100	100	100	100	100	23	0	14	0	0	23
Long Term												
Full Simulation Period ^b	95	99	99	100	99	96	73	70	67	35	24	51
Water Year Types^c												
Wet (23%)	99	100	100	100	96	98	92	91	77	66	30	53
Above Normal (24%)	98	99	100	100	100	100	94	100	90	34	22	58
Below Normal (10%)	96	100	91	100	100	100	62	73	64	23	18	56
Dry (16%)	89	100	100	100	100	98	68	46	59	16	20	42
Critical (27%)	94	97	100	100	100	83	30	30	40	15	25	50

Alternative 3 minus Revised Second Basis of Comparison

Statistic	Monthly Percentage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	88%	33%	6%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	52%	21%	6%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	37%	2%	3%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	18%	2%	-1%
50%	0%	0%	0%	0%	0%	0%	-3%	0%	7%	1%	0%	0%
60%	0%	0%	0%	0%	0%	0%	-13%	-8%	-13%	-5%	-4%	-6%
70%	0%	0%	0%	0%	0%	0%	-18%	-17%	-21%	-8%	8%	-9%
80%	-3%	0%	0%	0%	0%	0%	-14%	-53%	-10%	-29%	-5%	-20%
90%	-7%	0%	0%	0%	0%	0%	-36%	-98%	-34%	-100%	-99%	1%
Long Term												
Full Simulation Period ^b	-2%	0%	-1%	0%	2%	-1%	-8%	-8%	-5%	24%	10%	-4%
Water Year Types^c												
Wet (23%)	0%	0%	0%	0%	0%	0%	1%	-7%	-20%	62%	34%	12%
Above Normal (24%)	2%	0%	0%	0%	0%	0%	1%	0%	24%	17%	-6%	-4%
Below Normal (10%)	0%	0%	-9%	0%	2%	0%	-17%	-1%	-1%	-7%	-18%	-2%
Dry (16%)	-7%	1%	0%	0%	4%	0%	-16%	-23%	1%	-22%	-4%	-20%
Critical (27%)	-5%	-3%	0%	0%	4%	-5%	-28%	-10%	2%	-19%	25%	-12%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.21.4 New Melones Large Mouth Bass Nest Survival Percentage, Monthly Percentage

Revised Second Basis of Comparison

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	53	33	74
20%	100	100	100	100	100	100	100	100	100	38	30	65
30%	100	100	100	100	100	100	100	100	100	31	29	59
40%	100	100	100	100	100	100	100	100	100	27	26	57
50%	100	100	100	100	100	100	100	100	93	24	23	54
60%	100	100	100	100	100	100	86	100	63	22	21	51
70%	100	100	100	100	100	100	69	53	44	19	17	47
80%	97	100	100	100	100	100	49	43	31	16	11	39
90%	90	100	100	100	100	100	36	24	21	12	7	23
Long Term												
Full Simulation Period ^b	97	100	100	100	97	97	79	76	71	29	22	54
Water Year Types^c												
Wet (23%)	99	100	100	100	96	97	91	98	96	41	22	47
Above Normal (24%)	96	99	100	100	100	100	93	100	72	29	23	61
Below Normal (10%)	96	100	100	100	98	100	74	73	65	25	22	57
Dry (16%)	96	99	100	100	96	98	81	60	58	20	21	53
Critical (27%)	99	100	100	100	96	87	42	34	40	19	20	57

Alternative 5

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	75	36	98
20%	100	100	100	100	100	100	100	100	100	42	24	62
30%	88	100	100	100	100	100	100	100	100	30	22	57
40%	75	100	100	100	100	100	100	100	100	23	20	55
50%	69	100	100	100	100	100	72	100	100	20	19	50
60%	57	100	100	100	100	100	43	60	79	16	16	44
70%	51	100	100	100	100	100	24	29	43	12	11	39
80%	46	100	100	100	100	100	10	1	25	5	5	35
90%	35	100	100	100	100	95	0	0	7	0	0	13
Long Term												
Full Simulation Period ^b	67	100	100	100	98	95	60	64	70	28	21	50
Water Year Types^c												
Wet (23%)	71	100	100	100	96	95	87	93	97	41	19	47
Above Normal (24%)	73	99	100	100	100	100	79	94	61	21	17	53
Below Normal (10%)	58	100	100	100	98	95	50	58	59	18	14	44
Dry (16%)	58	99	100	100	100	98	45	37	52	10	13	45
Critical (27%)	73	100	100	100	99	85	14	19	60	44	50	67

Alternative 5 minus Revised Second Basis of Comparison

Statistic	Monthly Percentage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	40%	10%	33%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	11%	-21%	-4%
30%	-12%	0%	0%	0%	0%	0%	0%	0%	0%	-3%	-24%	-4%
40%	-25%	0%	0%	0%	0%	0%	0%	0%	0%	-13%	-25%	-3%
50%	-31%	0%	0%	0%	0%	0%	-28%	0%	7%	-16%	-19%	-8%
60%	-43%	0%	0%	0%	0%	0%	-50%	-40%	26%	-27%	-21%	-14%
70%	-49%	0%	0%	0%	0%	0%	-65%	-45%	-3%	-38%	-33%	-16%
80%	-53%	0%	0%	0%	0%	0%	-80%	-97%	-19%	-72%	-53%	-10%
90%	-62%	0%	0%	0%	0%	-5%	-100%	-100%	-66%	-99%	-99%	-44%
Long Term												
Full Simulation Period ^b	-31%	0%	0%	0%	1%	-2%	-25%	-16%	-1%	-3%	-3%	-7%
Water Year Types^c												
Wet (23%)	-28%	0%	0%	0%	0%	-3%	-5%	-5%	1%	1%	-14%	-1%
Above Normal (24%)	-24%	0%	0%	0%	0%	0%	-15%	-6%	-16%	-29%	-27%	-12%
Below Normal (10%)	-40%	0%	0%	0%	0%	-5%	-33%	-21%	-9%	-27%	-39%	-24%
Dry (16%)	-39%	0%	0%	0%	4%	0%	-45%	-38%	-9%	-51%	-39%	-15%
Critical (27%)	-26%	0%	0%	0%	3%	-2%	-67%	-43%	51%	134%	148%	17%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

5C.3.2.22 New Melones Small Mouth Bass Nest Survival Percentage

Table 5C.3.2.22.1 New Melones Small Mouth Bass Nest Survival Percentage, Monthly Percentage

No Action Alternative

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	56	32	67
20%	84	100	100	100	100	100	100	100	100	42	26	54
30%	71	100	100	100	100	100	100	100	100	27	22	50
40%	62	100	100	100	100	100	100	100	100	22	20	48
50%	57	100	100	100	100	100	67	100	86	20	18	46
60%	50	100	100	100	100	100	60	91	53	16	17	42
70%	43	100	100	100	100	100	42	34	35	12	15	37
80%	37	100	100	100	100	100	23	25	24	9	11	33
90%	25	100	100	100	100	85	12	13	14	2	4	29
Long Term												
Full Simulation Period ^b	58	98	100	100	96	94	65	70	66	26	21	47
Water Year Types^c												
Wet (23%)	59	100	100	100	96	93	81	97	93	42	21	43
Above Normal (24%)	64	98	100	100	100	100	86	99	68	22	18	52
Below Normal (10%)	54	100	100	100	97	94	55	63	59	19	17	50
Dry (16%)	55	97	100	100	97	98	59	48	50	12	15	43
Critical (27%)	58	95	100	99	92	82	26	23	40	25	36	53

Revised Alternative 1

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	45	28	62
20%	100	100	100	100	100	100	100	100	100	32	26	55
30%	100	100	100	100	100	100	100	100	100	27	25	50
40%	100	100	100	100	100	100	100	100	100	23	23	48
50%	100	100	100	100	100	100	100	100	78	21	20	46
60%	93	100	100	100	100	100	72	100	53	19	18	43
70%	88	100	100	100	100	100	58	45	38	17	15	40
80%	81	100	100	100	100	100	42	37	26	15	10	33
90%	76	92	100	100	100	100	31	21	19	11	7	20
Long Term												
Full Simulation Period ^b	92	98	100	100	96	96	75	74	67	25	19	46
Water Year Types^c												
Wet (23%)	94	100	100	100	96	97	88	98	94	36	20	40
Above Normal (24%)	92	97	100	100	100	100	92	100	68	25	20	53
Below Normal (10%)	86	99	100	100	97	100	69	70	62	22	20	50
Dry (16%)	88	97	100	100	96	98	75	55	53	18	18	46
Critical (27%)	98	96	100	100	94	83	37	30	37	17	18	49

Revised Alternative 1 minus No Action Alternative

Statistic	Monthly Percentage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-19%	-13%	-8%
20%	19%	0%	0%	0%	0%	0%	0%	0%	0%	-23%	2%	1%
30%	42%	0%	0%	0%	0%	0%	0%	0%	0%	0%	14%	0%
40%	61%	0%	0%	0%	0%	0%	0%	0%	0%	6%	15%	0%
50%	76%	0%	0%	0%	0%	0%	49%	0%	-10%	5%	12%	0%
60%	87%	0%	0%	0%	0%	0%	20%	10%	-1%	18%	11%	3%
70%	106%	0%	0%	0%	0%	0%	40%	31%	7%	45%	2%	7%
80%	122%	0%	0%	0%	0%	0%	81%	46%	11%	54%	-4%	2%
90%	204%	-8%	0%	0%	0%	18%	164%	67%	38%	399%	66%	-31%
Long Term												
Full Simulation Period ^b	59%	0%	0%	0%	0%	2%	17%	6%	1%	-4%	-6%	-2%
Water Year Types^c												
Wet (23%)	61%	0%	0%	0%	0%	4%	9%	0%	1%	-14%	-6%	-8%
Above Normal (24%)	44%	-1%	0%	0%	0%	0%	8%	1%	1%	13%	14%	1%
Below Normal (10%)	61%	-1%	0%	0%	0%	6%	25%	13%	5%	10%	15%	0%
Dry (16%)	59%	0%	0%	0%	0%	0%	28%	16%	6%	43%	26%	8%
Critical (27%)	69%	2%	0%	1%	2%	1%	44%	30%	-9%	-34%	-50%	-7%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.22.2 New Melones Small Mouth Bass Nest Survival Percentage, Monthly Percentage

Revised Second Basis of Comparison

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	45	28	62
20%	100	100	100	100	100	100	100	100	100	32	26	55
30%	100	100	100	100	100	100	100	100	100	27	25	50
40%	100	100	100	100	100	100	100	100	100	23	23	48
50%	100	100	100	100	100	100	100	100	78	21	20	46
60%	93	100	100	100	100	100	72	100	53	19	18	43
70%	88	100	100	100	100	100	58	45	38	17	15	40
80%	81	100	100	100	100	100	42	37	26	15	10	33
90%	76	92	100	100	100	100	31	21	19	11	7	20
Long Term												
Full Simulation Period ^b	92	98	100	100	96	96	75	74	67	25	19	46
Water Year Types^c												
Wet (23%)	94	100	100	100	96	97	88	98	94	36	20	40
Above Normal (24%)	92	97	100	100	100	100	92	100	68	25	20	53
Below Normal (10%)	86	99	100	100	97	100	69	70	62	22	20	50
Dry (16%)	88	97	100	100	96	98	75	55	53	18	18	46
Critical (27%)	98	96	100	100	94	83	37	30	37	17	18	49

No Action Alternative

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	56	32	67
20%	84	100	100	100	100	100	100	100	100	42	26	54
30%	71	100	100	100	100	100	100	100	100	27	22	50
40%	62	100	100	100	100	100	100	100	100	22	20	48
50%	57	100	100	100	100	100	67	100	86	20	18	46
60%	50	100	100	100	100	100	60	91	53	16	17	42
70%	43	100	100	100	100	100	42	34	35	12	15	37
80%	37	100	100	100	100	100	23	25	24	9	11	33
90%	25	100	100	100	100	85	12	13	14	2	4	29
Long Term												
Full Simulation Period ^b	58	98	100	100	96	94	65	70	66	26	21	47
Water Year Types^c												
Wet (23%)	59	100	100	100	96	93	81	97	93	42	21	43
Above Normal (24%)	64	98	100	100	100	100	86	99	68	22	18	52
Below Normal (10%)	54	100	100	100	97	94	55	63	59	19	17	50
Dry (16%)	55	97	100	100	97	98	59	48	50	12	15	43
Critical (27%)	58	95	100	99	92	82	26	23	40	25	36	53

No Action Alternative minus Revised Second Basis of Comparison

Statistic	Monthly Percentage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	24%	15%	8%
20%	-16%	0%	0%	0%	0%	0%	0%	0%	0%	30%	-2%	-1%
30%	-29%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-12%	0%
40%	-38%	0%	0%	0%	0%	0%	0%	0%	0%	-5%	-13%	0%
50%	-43%	0%	0%	0%	0%	0%	-33%	0%	11%	-5%	-11%	0%
60%	-47%	0%	0%	0%	0%	0%	-17%	-9%	1%	-15%	-10%	-3%
70%	-51%	0%	0%	0%	0%	0%	-28%	-24%	-6%	-31%	-2%	-7%
80%	-55%	0%	0%	0%	0%	0%	-45%	-31%	-10%	-35%	4%	-2%
90%	-67%	9%	0%	0%	0%	-15%	-62%	-40%	-28%	-80%	-40%	44%
Long Term												
Full Simulation Period ^b	-37%	0%	0%	0%	0%	-2%	-14%	-6%	-1%	4%	7%	2%
Water Year Types^c												
Wet (23%)	-38%	0%	0%	0%	0%	-4%	-8%	0%	-1%	16%	7%	8%
Above Normal (24%)	-30%	1%	0%	0%	0%	0%	-7%	-1%	-1%	-12%	-13%	-1%
Below Normal (10%)	-38%	1%	0%	0%	0%	-6%	-20%	-11%	-5%	-10%	-13%	0%
Dry (16%)	-37%	0%	0%	0%	0%	0%	-22%	-14%	-6%	-30%	-21%	-7%
Critical (27%)	-41%	-2%	0%	-1%	-2%	-1%	-30%	-23%	9%	51%	100%	8%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.22.3 New Melones Small Mouth Bass Nest Survival Percentage, Monthly Percentage

Revised Second Basis of Comparison

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	45	28	62
20%	100	100	100	100	100	100	100	100	100	32	26	55
30%	100	100	100	100	100	100	100	100	100	27	25	50
40%	100	100	100	100	100	100	100	100	100	23	23	48
50%	100	100	100	100	100	100	100	100	78	21	20	46
60%	93	100	100	100	100	100	72	100	53	19	18	43
70%	88	100	100	100	100	100	58	45	38	17	15	40
80%	81	100	100	100	100	100	42	37	26	15	10	33
90%	76	92	100	100	100	100	31	21	19	11	7	20
Long Term												
Full Simulation Period ^b	92	98	100	100	96	96	75	74	67	25	19	46
Water Year Types^c												
Wet (23%)	94	100	100	100	96	97	88	98	94	36	20	40
Above Normal (24%)	92	97	100	100	100	100	92	100	68	25	20	53
Below Normal (10%)	86	99	100	100	97	100	69	70	62	22	20	50
Dry (16%)	88	97	100	100	96	98	75	55	53	18	18	46
Critical (27%)	98	96	100	100	94	83	37	30	37	17	18	49

Alternative 3

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	100	37	66
20%	100	100	100	100	100	100	100	100	100	48	31	58
30%	100	100	100	100	100	100	100	100	100	36	25	52
40%	100	100	100	100	100	100	100	100	100	27	23	48
50%	99	100	100	100	100	100	81	100	100	21	20	46
60%	97	100	100	100	100	100	63	81	46	18	18	41
70%	84	100	100	100	100	100	48	38	30	16	16	36
80%	79	100	100	100	100	100	36	18	24	11	10	27
90%	70	88	100	100	100	100	20	0	13	0	0	20
Long Term												
Full Simulation Period ^b	90	98	99	100	99	96	70	69	65	32	21	44
Water Year Types^c												
Wet (23%)	94	100	100	100	96	98	89	90	77	62	26	45
Above Normal (24%)	93	98	100	100	100	100	93	100	88	30	19	50
Below Normal (10%)	90	100	91	100	100	100	57	69	61	20	16	49
Dry (16%)	81	96	100	100	100	97	62	44	54	14	18	37
Critical (27%)	90	92	100	100	99	79	27	27	37	13	23	44

Alternative 3 minus Revised Second Basis of Comparison

Statistic	Monthly Percentage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	122%	31%	6%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	50%	20%	6%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	35%	2%	3%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	17%	2%	-1%
50%	-1%	0%	0%	0%	0%	0%	-19%	0%	28%	1%	0%	0%
60%	4%	0%	0%	0%	0%	0%	-13%	-19%	-12%	-5%	-4%	-6%
70%	-5%	0%	0%	0%	0%	0%	-17%	-17%	-21%	-7%	8%	-9%
80%	-3%	0%	0%	0%	0%	0%	-14%	-51%	-9%	-27%	-5%	-19%
90%	-7%	-4%	0%	0%	0%	0%	-35%	-98%	-32%	-96%	-98%	1%
Long Term												
Full Simulation Period ^b	-2%	-1%	-1%	0%	2%	-1%	-8%	-8%	-3%	29%	10%	-4%
Water Year Types^c												
Wet (23%)	0%	0%	0%	0%	0%	0%	1%	-8%	-18%	72%	32%	12%
Above Normal (24%)	1%	1%	0%	0%	0%	0%	1%	0%	28%	16%	-7%	-4%
Below Normal (10%)	4%	1%	-9%	0%	3%	0%	-17%	-1%	-1%	-8%	-18%	-2%
Dry (16%)	-7%	-1%	0%	0%	4%	0%	-18%	-20%	1%	-22%	-4%	-20%
Critical (27%)	-8%	-4%	0%	0%	5%	-5%	-27%	-9%	2%	-20%	31%	-11%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.22.4 New Melones Small Mouth Bass Nest Survival Percentage, Monthly Percentage

Revised Second Basis of Comparison

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	45	28	62
20%	100	100	100	100	100	100	100	100	100	32	26	55
30%	100	100	100	100	100	100	100	100	100	27	25	50
40%	100	100	100	100	100	100	100	100	100	23	23	48
50%	100	100	100	100	100	100	100	100	78	21	20	46
60%	93	100	100	100	100	100	72	100	53	19	18	43
70%	88	100	100	100	100	100	58	45	38	17	15	40
80%	81	100	100	100	100	100	42	37	26	15	10	33
90%	76	92	100	100	100	100	31	21	19	11	7	20
Long Term												
Full Simulation Period ^b	92	98	100	100	96	96	75	74	67	25	19	46
Water Year Types^c												
Wet (23%)	94	100	100	100	96	97	88	98	94	36	20	40
Above Normal (24%)	92	97	100	100	100	100	92	100	68	25	20	53
Below Normal (10%)	86	99	100	100	97	100	69	70	62	22	20	50
Dry (16%)	88	97	100	100	96	98	75	55	53	18	18	46
Critical (27%)	98	96	100	100	94	83	37	30	37	17	18	49

Alternative 5

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	63	31	88
20%	87	100	100	100	100	100	100	100	100	36	21	53
30%	74	100	100	100	100	100	100	100	100	26	19	48
40%	63	100	100	100	100	100	100	100	100	20	17	47
50%	58	100	100	100	100	100	60	100	100	18	17	42
60%	48	100	100	100	100	100	37	51	66	14	15	37
70%	43	100	100	100	100	100	21	25	37	11	10	34
80%	39	100	100	100	100	100	9	2	22	5	6	30
90%	30	100	100	100	100	80	0	0	7	0	1	12
Long Term												
Full Simulation Period ^b	59	99	100	100	98	94	57	62	67	25	20	44
Water Year Types^c												
Wet (23%)	61	100	100	100	96	95	84	90	94	36	17	40
Above Normal (24%)	65	98	100	100	100	100	76	93	58	18	15	46
Below Normal (10%)	51	100	100	100	97	94	47	56	57	16	12	39
Dry (16%)	52	97	100	100	100	97	43	36	49	9	12	39
Critical (27%)	68	98	100	100	98	81	13	19	58	43	50	63

Alternative 5 minus Revised Second Basis of Comparison

Statistic	Monthly Percentage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	39%	10%	41%
20%	-13%	0%	0%	0%	0%	0%	0%	0%	0%	11%	-20%	-4%
30%	-26%	0%	0%	0%	0%	0%	0%	0%	0%	-3%	-23%	-4%
40%	-37%	0%	0%	0%	0%	0%	0%	0%	0%	-13%	-24%	-3%
50%	-42%	0%	0%	0%	0%	0%	-40%	0%	28%	-15%	-18%	-8%
60%	-48%	0%	0%	0%	0%	0%	-50%	-49%	25%	-25%	-19%	-14%
70%	-51%	0%	0%	0%	0%	0%	-64%	-44%	-3%	-35%	-30%	-16%
80%	-52%	0%	0%	0%	0%	0%	-78%	-94%	-18%	-66%	-47%	-10%
90%	-61%	9%	0%	0%	0%	-20%	-100%	-100%	-62%	-98%	-82%	-41%
Long Term												
Full Simulation Period ^b	-36%	1%	0%	0%	2%	-2%	-24%	-16%	0%	0%	2%	-5%
Water Year Types^c												
Wet (23%)	-35%	0%	0%	0%	0%	-3%	-4%	-8%	1%	1%	-13%	-1%
Above Normal (24%)	-29%	1%	0%	0%	0%	0%	-17%	-7%	-15%	-29%	-25%	-12%
Below Normal (10%)	-41%	1%	0%	0%	0%	-6%	-32%	-20%	-7%	-26%	-37%	-23%
Dry (16%)	-41%	0%	0%	0%	4%	-1%	-43%	-36%	-9%	-48%	-37%	-14%
Critical (27%)	-31%	2%	0%	0%	4%	-2%	-65%	-37%	60%	157%	179%	28%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

5C.3.2.23 New Melones Spotted Bass Nest Survival Percentage

Table 5C.3.2.23.1 New Melones Spotted Bass Nest Survival Percentage, Monthly Percentage

No Action Alternative

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	100	100	100
20%	100	100	100	100	100	100	100	100	100	100	100	91
30%	100	100	100	100	100	100	100	100	100	100	93	85
40%	100	100	100	100	100	100	100	100	100	100	85	81
50%	100	100	100	100	100	100	100	100	100	100	81	78
60%	100	100	100	100	100	100	100	100	100	100	75	76
70%	100	100	100	100	100	100	100	100	100	100	68	73
80%	100	100	100	100	100	100	100	87	91	88	64	66
90%	90	100	100	100	100	100	100	68	69	71	51	55
Long Term												
Full Simulation Period ^b	94	100	100	100	99	99	90	91	91	77	76	97
Water Year Types^c												
Wet (23%)	88	100	100	100	98	96	88	100	96	84	79	96
Above Normal (24%)	99	100	100	100	100	100	98	100	99	77	78	100
Below Normal (10%)	91	100	100	100	100	100	90	90	94	80	77	99
Dry (16%)	97	100	100	100	100	100	97	92	89	69	72	99
Critical (27%)	99	100	100	100	100	100	73	62	72	75	75	94

Revised Alternative 1

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	100	96	100
20%	100	100	100	100	100	100	100	100	100	100	92	100
30%	100	100	100	100	100	100	100	100	100	100	93	100
40%	100	100	100	100	100	100	100	100	100	100	87	100
50%	100	100	100	100	100	100	100	100	100	100	83	100
60%	100	100	100	100	100	100	100	100	100	100	80	100
70%	100	100	100	100	100	100	100	100	100	100	77	100
80%	100	100	100	100	100	100	100	100	100	93	73	100
90%	100	100	100	100	100	100	100	84	79	66	60	82
Long Term												
Full Simulation Period ^b	100	100	100	100	99	100	98	95	95	83	79	97
Water Year Types^c												
Wet (23%)	100	100	100	100	97	100	100	100	100	93	81	93
Above Normal (24%)	100	100	100	100	100	100	99	100	100	83	82	100
Below Normal (10%)	100	100	100	100	100	100	99	94	98	82	81	99
Dry (16%)	100	100	100	100	99	100	100	96	93	78	79	99
Critical (27%)	100	100	100	100	100	100	87	75	82	69	71	99

Revised Alternative 1 minus No Action Alternative

Statistic	Monthly Percentage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-4%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	6%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	2%	6%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	2%	5%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	6%	4%	0%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	13%	1%	0%
80%	0%	0%	0%	0%	0%	0%	15%	10%	5%	14%	-1%	0%
90%	11%	0%	0%	0%	0%	0%	48%	21%	12%	29%	9%	-16%
Long Term												
Full Simulation Period ^b	6%	0%	0%	0%	0%	1%	9%	4%	4%	7%	4%	0%
Water Year Types^c												
Wet (23%)	13%	0%	0%	0%	-1%	4%	13%	0%	4%	11%	3%	-2%
Above Normal (24%)	1%	0%	0%	0%	0%	0%	1%	0%	0%	8%	6%	0%
Below Normal (10%)	10%	0%	0%	0%	0%	0%	10%	4%	4%	3%	6%	0%
Dry (16%)	3%	0%	0%	0%	-1%	0%	3%	5%	4%	13%	9%	0%
Critical (27%)	1%	0%	0%	0%	0%	0%	19%	21%	13%	-7%	-5%	5%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.23.2 New Melones Spotted Bass Nest Survival Percentage, Monthly Percentage

Revised Second Basis of Comparison

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	100	96	100
20%	100	100	100	100	100	100	100	100	100	100	92	100
30%	100	100	100	100	100	100	100	100	100	93	90	100
40%	100	100	100	100	100	100	100	100	100	87	86	100
50%	100	100	100	100	100	100	100	100	100	83	82	100
60%	100	100	100	100	100	100	100	100	100	80	79	100
70%	100	100	100	100	100	100	100	100	100	77	73	100
80%	100	100	100	100	100	100	100	100	93	73	66	100
90%	100	100	100	100	100	100	100	84	79	66	60	82
Long Term												
Full Simulation Period ^b	100	100	100	100	99	100	98	95	95	83	79	97
Water Year Types^c												
Wet (23%)	100	100	100	100	97	100	100	100	100	93	81	93
Above Normal (24%)	100	100	100	100	100	100	99	100	100	83	82	100
Below Normal (10%)	100	100	100	100	100	100	99	94	98	82	81	99
Dry (16%)	100	100	100	100	99	100	100	96	93	78	79	99
Critical (27%)	100	100	100	100	100	100	87	75	82	69	71	99

No Action Alternative

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	100	100	100
20%	100	100	100	100	100	100	100	100	100	100	91	100
30%	100	100	100	100	100	100	100	100	100	93	85	100
40%	100	100	100	100	100	100	100	100	100	85	81	100
50%	100	100	100	100	100	100	100	100	100	81	78	100
60%	100	100	100	100	100	100	100	100	100	75	76	100
70%	100	100	100	100	100	100	100	100	100	68	73	100
80%	100	100	100	100	100	100	87	91	88	64	66	100
90%	90	100	100	100	100	100	68	69	71	51	55	97
Long Term												
Full Simulation Period ^b	94	100	100	100	99	99	90	91	91	77	76	97
Water Year Types^c												
Wet (23%)	88	100	100	100	98	96	88	100	96	84	79	96
Above Normal (24%)	99	100	100	100	100	100	98	100	99	77	78	100
Below Normal (10%)	91	100	100	100	100	100	90	90	94	80	77	99
Dry (16%)	97	100	100	100	100	100	97	92	89	69	72	99
Critical (27%)	99	100	100	100	100	100	73	62	72	75	75	94

No Action Alternative minus Revised Second Basis of Comparison

Statistic	Monthly Percentage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	4%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-6%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-2%	-6%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-2%	-5%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-6%	-4%	0%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-12%	-1%	0%
80%	0%	0%	0%	0%	0%	0%	-13%	-9%	-5%	-12%	1%	0%
90%	-10%	0%	0%	0%	0%	0%	-32%	-17%	-11%	-23%	-8%	18%
Long Term												
Full Simulation Period ^b	-6%	0%	0%	0%	0%	-1%	-8%	-4%	-4%	-7%	-4%	0%
Water Year Types^c												
Wet (23%)	-12%	0%	0%	0%	1%	-4%	-12%	0%	-4%	-10%	-3%	2%
Above Normal (24%)	-1%	0%	0%	0%	0%	0%	-1%	0%	0%	-7%	-5%	0%
Below Normal (10%)	-9%	0%	0%	0%	0%	0%	-9%	-4%	-4%	-3%	-5%	0%
Dry (16%)	-3%	0%	0%	0%	1%	0%	-3%	-5%	-4%	-12%	-8%	0%
Critical (27%)	-1%	0%	0%	0%	0%	0%	-16%	-18%	-12%	8%	5%	-5%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.23.3 New Melones Spotted Bass Nest Survival Percentage, Monthly Percentage

Revised Second Basis of Comparison

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	100	96	100
20%	100	100	100	100	100	100	100	100	100	100	92	100
30%	100	100	100	100	100	100	100	100	100	93	90	100
40%	100	100	100	100	100	100	100	100	100	87	86	100
50%	100	100	100	100	100	100	100	100	100	83	82	100
60%	100	100	100	100	100	100	100	100	100	80	79	100
70%	100	100	100	100	100	100	100	100	100	77	73	100
80%	100	100	100	100	100	100	100	100	93	73	66	100
90%	100	100	100	100	100	100	100	84	79	66	60	82
Long Term												
Full Simulation Period ^b	100	100	100	100	99	100	98	95	95	83	79	97
Water Year Types^c												
Wet (23%)	100	100	100	100	97	100	100	100	100	93	81	93
Above Normal (24%)	100	100	100	100	100	100	99	100	100	83	82	100
Below Normal (10%)	100	100	100	100	100	100	99	94	98	82	81	99
Dry (16%)	100	100	100	100	99	100	100	96	93	78	79	99
Critical (27%)	100	100	100	100	100	100	87	75	82	69	71	99

Alternative 3

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	100	100	100
20%	100	100	100	100	100	100	100	100	100	100	100	100
30%	100	100	100	100	100	100	100	100	100	100	91	100
40%	100	100	100	100	100	100	100	100	100	94	87	100
50%	100	100	100	100	100	100	100	100	100	83	82	100
60%	100	100	100	100	100	100	100	100	100	79	78	100
70%	100	100	100	100	100	100	100	100	98	75	75	100
80%	100	100	100	100	100	100	100	79	88	66	65	94
90%	100	100	100	100	100	100	82	38	69	48	38	82
Long Term												
Full Simulation Period ^b	100	100	99	100	99	99	94	86	88	78	75	91
Water Year Types^c												
Wet (23%)	100	100	100	100	98	100	100	92	77	98	87	98
Above Normal (24%)	100	100	100	100	100	100	100	100	99	80	68	92
Below Normal (10%)	100	100	91	100	100	100	90	95	97	69	66	98
Dry (16%)	100	100	100	100	100	100	93	73	93	67	74	79
Critical (27%)	100	100	100	100	100	92	79	71	83	63	70	89

Alternative 3 minus Revised Second Basis of Comparison

Statistic	Monthly Percentage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	4%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	8%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	7%	1%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	8%	1%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-2%	-2%	0%
70%	0%	0%	0%	0%	0%	0%	0%	0%	-2%	-3%	3%	0%
80%	0%	0%	0%	0%	0%	0%	0%	-21%	-5%	-9%	-1%	-6%
90%	0%	0%	0%	0%	0%	0%	-18%	-55%	-13%	-27%	-37%	1%
Long Term												
Full Simulation Period ^b	0%	0%	-1%	0%	0%	-1%	-4%	-9%	-8%	-5%	-5%	-6%
Water Year Types^c												
Wet (23%)	0%	0%	0%	0%	1%	0%	0%	-8%	-23%	5%	8%	5%
Above Normal (24%)	0%	0%	0%	0%	0%	0%	1%	0%	0%	-3%	-18%	-8%
Below Normal (10%)	0%	0%	-9%	0%	0%	0%	-9%	0%	-1%	-16%	-18%	0%
Dry (16%)	0%	0%	0%	0%	1%	0%	-7%	-24%	1%	-14%	-6%	-20%
Critical (27%)	0%	0%	0%	0%	0%	-8%	-9%	-6%	1%	-10%	-2%	-10%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.23.4 New Melones Spotted Bass Nest Survival Percentage, Monthly Percentage

Revised Second Basis of Comparison

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	100	96	100
20%	100	100	100	100	100	100	100	100	100	100	92	100
30%	100	100	100	100	100	100	100	100	100	93	90	100
40%	100	100	100	100	100	100	100	100	100	87	86	100
50%	100	100	100	100	100	100	100	100	100	83	82	100
60%	100	100	100	100	100	100	100	100	100	80	79	100
70%	100	100	100	100	100	100	100	100	100	77	73	100
80%	100	100	100	100	100	100	100	100	93	73	66	100
90%	100	100	100	100	100	100	100	84	79	66	60	82
Long Term												
Full Simulation Period ^b	100	100	100	100	99	100	98	95	95	83	79	97
Water Year Types^c												
Wet (23%)	100	100	100	100	97	100	100	100	100	93	81	93
Above Normal (24%)	100	100	100	100	100	100	99	100	100	83	82	100
Below Normal (10%)	100	100	100	100	100	100	99	94	98	82	81	99
Dry (16%)	100	100	100	100	99	100	100	96	93	78	79	99
Critical (27%)	100	100	100	100	100	100	87	75	82	69	71	99

Alternative 5

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	100	99	100
20%	100	100	100	100	100	100	100	100	100	100	83	100
30%	100	100	100	100	100	100	100	100	100	92	80	100
40%	100	100	100	100	100	100	100	100	100	82	77	100
50%	100	100	100	100	100	100	100	100	100	78	76	100
60%	100	100	100	100	100	100	100	100	100	72	73	100
70%	100	100	100	100	100	100	84	91	100	67	65	100
80%	100	100	100	100	100	100	63	52	84	56	57	99
90%	98	100	100	100	100	100	27	9	60	33	50	68
Long Term												
Full Simulation Period ^b	96	100	100	100	99	100	81	80	88	72	71	91
Water Year Types^c												
Wet (23%)	99	100	100	100	97	99	99	100	100	90	76	94
Above Normal (24%)	99	100	100	100	100	100	90	100	76	66	74	92
Below Normal (10%)	87	100	100	100	100	100	78	74	92	65	65	79
Dry (16%)	93	100	100	100	100	100	78	71	85	56	59	93
Critical (27%)	97	100	100	100	100	100	38	38	80	73	80	92

Alternative 5 minus Revised Second Basis of Comparison

Statistic	Monthly Percentage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	4%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-10%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-2%	-11%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-6%	-11%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-6%	-8%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-10%	-8%	0%
70%	0%	0%	0%	0%	0%	0%	-16%	-9%	0%	-13%	-11%	0%
80%	0%	0%	0%	0%	0%	0%	-37%	-48%	-9%	-23%	-13%	-1%
90%	-2%	0%	0%	0%	0%	0%	-73%	-89%	-25%	-50%	-16%	-17%
Long Term												
Full Simulation Period ^b	-4%	0%	0%	0%	0%	0%	-17%	-15%	-7%	-13%	-11%	-6%
Water Year Types^c												
Wet (23%)	-1%	0%	0%	0%	-1%	-1%	-1%	0%	0%	-3%	-6%	1%
Above Normal (24%)	-1%	0%	0%	0%	0%	0%	-9%	0%	-24%	-21%	-10%	-8%
Below Normal (10%)	-13%	0%	0%	0%	0%	0%	-22%	-22%	-6%	-21%	-21%	-20%
Dry (16%)	-7%	0%	0%	0%	1%	0%	-22%	-26%	-9%	-28%	-25%	-6%
Critical (27%)	-3%	0%	0%	0%	0%	0%	-56%	-49%	-2%	5%	13%	-7%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.2.24 Temperature Threshold Exceedances

Species	Lifestage	River	Reach	Water Year Type	Month	Temperature Objective (Degree F)	Temperature Objective Reference ¹	No Action Alternative	Revised Second Basis of Comparison (Revised Alternative 1)	Alternative 3	Alternative 5	Revised Alternative 1 minus No Action Alternative	No Action Alternative minus Revised Second Basis of Comparison	Alternative 3 minus Revised Second Basis of Comparison	Alternative 5 minus Revised Second Basis of Comparison
Steelhead	Adult Migration	Stanislaus	Orange Blossom Bridge	All	October	56	NMFS BiOp 2009	57%	86%	87%	58%	29%	-29%	1%	-28%
Steelhead	Adult Migration	Stanislaus	Orange Blossom Bridge	All	November	56	NMFS BiOp 2009	33%	27%	24%	36%	-6%	6%	-3%	9%
Steelhead	Adult Migration	Stanislaus	Orange Blossom Bridge	All	December	56	NMFS BiOp 2009	0%	0%	0%	3%	0%	0%	0%	3%
Steelhead	Smoltification	Stanislaus	Knights Ferry ("Used Below Goodwin Dam)	All	January	52	NMFS BiOp 2009	0%	3%	2%	2%	3%	-3%	-1%	-1%
Steelhead	Smoltification	Stanislaus	Knights Ferry ("Used Below Goodwin Dam)	All	February	52	NMFS BiOp 2009	0%	3%	2%	0%	3%	-3%	-1%	-3%
Steelhead	Smoltification	Stanislaus	Knights Ferry ("Used Below Goodwin Dam)	All	March	52	NMFS BiOp 2009	8%	12%	12%	8%	4%	-4%	0%	-4%
Steelhead	Smoltification	Stanislaus	Knights Ferry ("Used Below Goodwin Dam)	All	April	52	NMFS BiOp 2009	33%	34%	30%	37%	2%	-2%	-4%	3%
Steelhead	Smoltification	Stanislaus	Knights Ferry ("Used Below Goodwin Dam)	All	May	52	NMFS BiOp 2009	63%	68%	63%	68%	5%	-5%	-5%	0%
Steelhead	Smoltification	Stanislaus	Orange Blossom Bridge	All	January	57	NMFS BiOp 2009	0%	0%	0%	0%	0%	0%	0%	0%
Steelhead	Smoltification	Stanislaus	Orange Blossom Bridge	All	February	57	NMFS BiOp 2009	0%	0%	0%	0%	0%	0%	0%	0%
Steelhead	Smoltification	Stanislaus	Orange Blossom Bridge	All	March	57	NMFS BiOp 2009	0%	10%	0%	0%	10%	-10%	-10%	-10%
Steelhead	Smoltification	Stanislaus	Orange Blossom Bridge	All	April	57	NMFS BiOp 2009	2%	7%	3%	0%	5%	-5%	-4%	-7%
Steelhead	Smoltification	Stanislaus	Orange Blossom Bridge	All	May	57	NMFS BiOp 2009	18%	22%	17%	8%	4%	-4%	-5%	-15%
Steelhead	Spawning	Stanislaus	Orange Blossom Bridge	All	January	55	NMFS BiOp 2009	0%	0%	0%	0%	0%	0%	0%	0%
Steelhead	Spawning	Stanislaus	Orange Blossom Bridge	All	February	55	NMFS BiOp 2009	0%	2%	1%	0%	2%	-2%	-1%	-2%
Steelhead	Spawning	Stanislaus	Orange Blossom Bridge	All	March	55	NMFS BiOp 2009	21%	35%	25%	21%	14%	-14%	-11%	-15%
Steelhead	Spawning	Stanislaus	Orange Blossom Bridge	All	April	55	NMFS BiOp 2009	16%	30%	17%	7%	14%	-14%	-12%	-23%
Steelhead	Spawning	Stanislaus	Orange Blossom Bridge	All	May	55	NMFS BiOp 2009	49%	57%	53%	40%	9%	-9%	-4%	-17%
Steelhead	Rearing	Stanislaus	Orange Blossom Bridge	All	June	65	NMFS BiOp 2009	6%	2%	4%	6%	-3%	3%	2%	4%
Steelhead	Rearing	Stanislaus	Orange Blossom Bridge	All	July	65	NMFS BiOp 2009	16%	15%	19%	21%	-2%	2%	5%	7%
Steelhead	Rearing	Stanislaus	Orange Blossom Bridge	All	August	65	NMFS BiOp 2009	15%	7%	9%	21%	-8%	8%	2%	13%
Steelhead	Rearing	Stanislaus	Orange Blossom Bridge	All	September	65	NMFS BiOp 2009	11%	7%	7%	18%	-4%	4%	0%	11%
Steelhead	Rearing	Stanislaus	Orange Blossom Bridge	All	October	65	NMFS BiOp 2009	7%	7%	4%	11%	0%	0%	-3%	4%
Steelhead	Rearing	Stanislaus	Orange Blossom Bridge	All	November	65	NMFS BiOp 2009	0%	0%	0%	0%	0%	0%	0%	0%

¹See Appendix 9N, Section C for the full reference

Table 5C.3.2.25 CVP Annual Power Generation Summary

				No Action Alternative	Revised Second Basis of Comparison (Revised Alternative 1)	Alternative 3	Alternative 5	Revised Alternative 1 vs. No Action Alternative (Percent Difference)	No Action Alternative vs. Revised Second Basis of Comparison (Percent Difference)	Alternative 3 vs. Revised Second Basis of Comparison (Percent Difference)	Alternative 5 vs. Revised Second Basis of Comparison (Percent Difference)
CVP Generation Facilities											
Capacity	At load center	(MW)	Long Term	1,583	1,651	1,642	1,568	4%	-4%	-1%	-5%
			Dry and Critical	1,203	1,327	1,291	1,173	10%	-9%	-3%	-12%
Energy Generation	Total of all Facilities at load center	(GWh)	Long Term	4,558	4,617	4,582	4,552	1%	-1%	-1%	-1%
			Dry and Critical	2,696	2,823	2,798	2,684	5%	-4%	-1%	-5%
CVP Pumping Facilities											
Energy Use	Total of all Facilities at load center	(GWh)	Long Term	1,113	1,285	1,238	1,110	15%	-13%	-4%	-14%
			Dry and Critical	699	769	715	699	10%	-9%	-7%	-9%
All CVP Facilities											
Net Generation	Total of all Facilities	(GWh)	Long Term	3,445	3,331	3,344	3,442	-3%	3%	0%	3%
			Dry and Critical	1,997	2,054	2,084	1,986	3%	-3%	1%	-3%

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in text.

This page left blank intentionally.

5C.3.3.1 New Melones Storage

Table 5C.3.3.1.1 New Melones Reservoir, End of Month Storage

No Action Alternative

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,765	1,759	1,823	1,880	1,931	1,980	1,945	2,052	2,075	1,978	1,869	1,805
20%	1,612	1,631	1,647	1,687	1,768	1,799	1,834	1,901	1,876	1,798	1,691	1,633
30%	1,533	1,534	1,556	1,598	1,686	1,729	1,686	1,745	1,786	1,707	1,605	1,556
40%	1,271	1,274	1,432	1,514	1,594	1,618	1,592	1,533	1,539	1,433	1,333	1,273
50%	1,121	1,127	1,154	1,307	1,436	1,535	1,461	1,444	1,392	1,283	1,190	1,156
60%	1,024	1,043	1,080	1,146	1,199	1,273	1,278	1,335	1,277	1,199	1,102	1,054
70%	882	911	986	1,015	1,038	1,057	1,080	1,090	1,087	994	910	868
80%	646	658	684	684	735	808	835	878	872	808	733	693
90%	430	435	440	488	541	569	574	586	630	566	507	473
Long Term												
Full Simulation Period ^b	1,132	1,142	1,180	1,237	1,305	1,348	1,337	1,373	1,381	1,300	1,208	1,159
Water Year Types^c												
Wet (32%)	1,379	1,390	1,454	1,562	1,666	1,724	1,758	1,878	1,968	1,890	1,773	1,703
Above Normal (16%)	1,029	1,060	1,125	1,214	1,317	1,406	1,413	1,484	1,467	1,372	1,277	1,232
Below Normal (13%)	1,294	1,305	1,326	1,351	1,413	1,438	1,390	1,383	1,359	1,268	1,175	1,133
Dry (24%)	1,094	1,094	1,106	1,121	1,156	1,188	1,154	1,132	1,087	997	914	871
Critical (15%)	624	623	638	645	661	656	602	554	526	476	431	408

Alternative 1

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,801	1,782	1,827	1,875	1,952	2,030	2,017	2,134	2,071	1,977	1,869	1,805
20%	1,657	1,655	1,665	1,690	1,847	1,928	1,884	1,963	1,884	1,830	1,719	1,663
30%	1,575	1,582	1,614	1,627	1,697	1,743	1,751	1,836	1,836	1,743	1,635	1,577
40%	1,366	1,372	1,472	1,556	1,621	1,675	1,649	1,601	1,619	1,510	1,415	1,362
50%	1,200	1,211	1,248	1,348	1,472	1,541	1,484	1,511	1,467	1,357	1,258	1,200
60%	1,089	1,093	1,124	1,209	1,259	1,341	1,373	1,379	1,317	1,224	1,134	1,089
70%	956	989	1,040	1,084	1,099	1,099	1,146	1,179	1,147	1,064	982	940
80%	711	712	730	753	825	932	914	945	903	837	758	712
90%	508	517	515	555	666	664	608	619	697	619	547	507
Long Term												
Full Simulation Period ^b	1,192	1,194	1,226	1,279	1,345	1,397	1,402	1,433	1,420	1,336	1,245	1,194
Water Year Types^c												
Wet (32%)	1,443	1,446	1,502	1,606	1,709	1,794	1,833	1,962	1,994	1,917	1,803	1,731
Above Normal (16%)	1,092	1,116	1,175	1,261	1,360	1,455	1,481	1,543	1,516	1,419	1,321	1,274
Below Normal (13%)	1,364	1,366	1,378	1,397	1,453	1,479	1,461	1,447	1,415	1,322	1,228	1,183
Dry (24%)	1,149	1,143	1,149	1,161	1,191	1,221	1,210	1,176	1,131	1,039	956	912
Critical (15%)	667	663	674	680	696	690	646	585	557	498	449	426

Alternative 1 minus No Action Alternative

Statistic	End of Month Storage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2%	1%	0%	0%	1%	3%	4%	4%	0%	0%	0%	0%
20%	3%	1%	1%	0%	4%	7%	3%	3%	0%	2%	2%	2%
30%	3%	3%	4%	2%	1%	1%	4%	5%	3%	2%	2%	1%
40%	7%	8%	3%	3%	2%	4%	4%	4%	5%	5%	6%	7%
50%	7%	7%	8%	3%	3%	0%	2%	5%	5%	6%	6%	4%
60%	6%	5%	4%	5%	5%	5%	7%	3%	3%	2%	3%	3%
70%	8%	9%	5%	7%	6%	4%	6%	8%	5%	7%	8%	8%
80%	10%	8%	7%	10%	12%	15%	9%	8%	4%	3%	3%	3%
90%	18%	19%	17%	14%	23%	17%	6%	6%	11%	9%	8%	7%
Long Term												
Full Simulation Period ^b	5%	5%	4%	3%	3%	4%	5%	4%	3%	3%	3%	3%
Water Year Types^c												
Wet (32%)	5%	4%	3%	3%	3%	4%	4%	4%	1%	1%	2%	2%
Above Normal (16%)	6%	5%	4%	4%	3%	3%	5%	4%	3%	3%	3%	3%
Below Normal (13%)	5%	5%	4%	3%	3%	3%	5%	5%	4%	4%	4%	4%
Dry (24%)	5%	5%	4%	4%	3%	3%	5%	4%	4%	4%	5%	5%
Critical (15%)	7%	6%	6%	6%	5%	5%	7%	6%	6%	5%	4%	4%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.1.2 New Melones Reservoir, End of Month Storage

Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,801	1,782	1,827	1,875	1,952	2,030	2,017	2,134	2,071	1,977	1,869	1,805
20%	1,657	1,655	1,665	1,690	1,847	1,928	1,884	1,963	1,884	1,830	1,719	1,663
30%	1,575	1,582	1,614	1,627	1,697	1,743	1,751	1,836	1,836	1,743	1,635	1,577
40%	1,366	1,372	1,472	1,556	1,621	1,675	1,649	1,601	1,619	1,510	1,415	1,362
50%	1,200	1,211	1,248	1,348	1,472	1,541	1,484	1,511	1,467	1,357	1,258	1,200
60%	1,089	1,093	1,124	1,209	1,259	1,341	1,373	1,379	1,317	1,224	1,134	1,089
70%	956	989	1,040	1,084	1,099	1,099	1,146	1,179	1,147	1,064	982	940
80%	711	712	730	753	825	932	914	945	903	837	758	712
90%	508	517	515	555	666	664	608	619	697	619	547	507
Long Term												
Full Simulation Period ^b	1,192	1,194	1,226	1,279	1,345	1,397	1,402	1,433	1,420	1,336	1,245	1,194
Water Year Types^c												
Wet (32%)	1,443	1,446	1,502	1,606	1,709	1,794	1,833	1,962	1,994	1,917	1,803	1,731
Above Normal (16%)	1,092	1,116	1,175	1,261	1,360	1,455	1,481	1,543	1,516	1,419	1,321	1,274
Below Normal (13%)	1,364	1,366	1,378	1,397	1,453	1,479	1,461	1,447	1,415	1,322	1,228	1,183
Dry (24%)	1,149	1,143	1,149	1,161	1,191	1,221	1,210	1,176	1,131	1,039	956	912
Critical (15%)	667	663	674	680	696	690	646	585	557	498	449	426

No Action Alternative

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,765	1,759	1,823	1,880	1,931	1,980	1,945	2,052	2,075	1,978	1,869	1,805
20%	1,612	1,631	1,647	1,687	1,768	1,799	1,834	1,901	1,876	1,798	1,691	1,633
30%	1,533	1,534	1,556	1,598	1,686	1,729	1,686	1,745	1,786	1,707	1,605	1,556
40%	1,271	1,274	1,432	1,514	1,594	1,618	1,592	1,533	1,539	1,433	1,333	1,273
50%	1,121	1,127	1,154	1,307	1,436	1,535	1,461	1,444	1,392	1,283	1,190	1,156
60%	1,024	1,043	1,080	1,146	1,199	1,273	1,278	1,335	1,277	1,199	1,102	1,054
70%	882	911	986	1,015	1,038	1,057	1,080	1,090	1,087	994	910	868
80%	646	658	684	684	735	808	835	878	872	808	733	693
90%	430	435	440	488	541	569	574	586	630	566	507	473
Long Term												
Full Simulation Period ^b	1,132	1,142	1,180	1,237	1,305	1,348	1,337	1,373	1,381	1,300	1,208	1,159
Water Year Types^c												
Wet (32%)	1,379	1,390	1,454	1,562	1,666	1,724	1,758	1,878	1,968	1,890	1,773	1,703
Above Normal (16%)	1,029	1,060	1,125	1,214	1,317	1,406	1,413	1,484	1,467	1,372	1,277	1,232
Below Normal (13%)	1,294	1,305	1,326	1,351	1,413	1,438	1,390	1,383	1,359	1,268	1,175	1,133
Dry (24%)	1,094	1,094	1,106	1,121	1,156	1,188	1,154	1,132	1,087	997	914	871
Critical (15%)	624	623	638	645	661	656	602	554	526	476	431	408

No Action Alternative minus Second Basis of Comparison

Statistic	End of Month Storage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-2%	-1%	0%	0%	-1%	-2%	-4%	-4%	0%	0%	0%	0%
20%	-3%	-1%	-1%	0%	-4%	-7%	-3%	-3%	0%	-2%	-2%	-2%
30%	-3%	-3%	-4%	-2%	-1%	-1%	-4%	-5%	-3%	-2%	-2%	-1%
40%	-7%	-7%	-3%	-3%	-2%	-3%	-3%	-4%	-5%	-5%	-6%	-7%
50%	-7%	-7%	-8%	-3%	-2%	0%	-2%	-4%	-5%	-5%	-5%	-4%
60%	-6%	-5%	-4%	-5%	-5%	-5%	-7%	-3%	-3%	-2%	-3%	-3%
70%	-8%	-8%	-5%	-6%	-6%	-4%	-6%	-8%	-5%	-7%	-7%	-8%
80%	-9%	-8%	-6%	-9%	-11%	-13%	-9%	-7%	-3%	-3%	-3%	-3%
90%	-15%	-16%	-15%	-12%	-19%	-14%	-6%	-5%	-10%	-9%	-7%	-7%
Long Term												
Full Simulation Period ^b	-5%	-4%	-4%	-3%	-3%	-3%	-5%	-4%	-3%	-3%	-3%	-3%
Water Year Types^c												
Wet (32%)	-4%	-4%	-3%	-3%	-3%	-4%	-4%	-4%	-1%	-1%	-2%	-2%
Above Normal (16%)	-6%	-5%	-4%	-4%	-3%	-3%	-5%	-4%	-3%	-3%	-3%	-3%
Below Normal (13%)	-5%	-4%	-4%	-3%	-3%	-3%	-5%	-4%	-4%	-4%	-4%	-4%
Dry (24%)	-5%	-4%	-4%	-3%	-3%	-3%	-5%	-4%	-4%	-4%	-4%	-5%
Critical (15%)	-7%	-6%	-5%	-5%	-5%	-5%	-7%	-5%	-6%	-5%	-4%	-4%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.1.3 New Melones Reservoir, End of Month Storage

Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,801	1,782	1,827	1,875	1,952	2,030	2,017	2,134	2,071	1,977	1,869	1,805
20%	1,657	1,655	1,665	1,690	1,847	1,928	1,884	1,963	1,884	1,830	1,719	1,663
30%	1,575	1,582	1,614	1,627	1,697	1,743	1,751	1,836	1,836	1,743	1,635	1,577
40%	1,366	1,372	1,472	1,556	1,621	1,675	1,649	1,601	1,619	1,510	1,415	1,362
50%	1,200	1,211	1,248	1,348	1,472	1,541	1,484	1,511	1,467	1,357	1,258	1,200
60%	1,089	1,093	1,124	1,209	1,259	1,341	1,373	1,379	1,317	1,224	1,134	1,089
70%	956	989	1,040	1,084	1,099	1,099	1,146	1,179	1,147	1,064	982	940
80%	711	712	730	753	825	932	914	945	903	837	758	712
90%	508	517	515	555	666	664	608	619	697	619	547	507
Long Term												
Full Simulation Period ^b	1,192	1,194	1,226	1,279	1,345	1,397	1,402	1,433	1,420	1,336	1,245	1,194
Water Year Types^c												
Wet (32%)	1,443	1,446	1,502	1,606	1,709	1,794	1,833	1,962	1,994	1,917	1,803	1,731
Above Normal (16%)	1,092	1,116	1,175	1,261	1,360	1,455	1,481	1,543	1,516	1,419	1,321	1,274
Below Normal (13%)	1,364	1,366	1,378	1,397	1,453	1,479	1,461	1,447	1,415	1,322	1,228	1,183
Dry (24%)	1,149	1,143	1,149	1,161	1,191	1,221	1,210	1,176	1,131	1,039	956	912
Critical (15%)	667	663	674	680	696	690	646	585	557	498	449	426

Alternative 3

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,967	1,954	1,970	1,970	1,970	2,030	2,062	2,198	2,284	2,209	2,103	2,000
20%	1,901	1,905	1,913	1,911	1,970	2,026	1,988	2,021	2,154	2,055	1,955	1,902
30%	1,729	1,727	1,790	1,857	1,925	1,975	1,910	1,972	1,983	1,877	1,785	1,736
40%	1,582	1,596	1,668	1,775	1,851	1,884	1,838	1,826	1,796	1,697	1,601	1,546
50%	1,427	1,416	1,439	1,556	1,660	1,719	1,674	1,721	1,675	1,561	1,460	1,409
60%	1,308	1,316	1,318	1,366	1,426	1,494	1,488	1,529	1,525	1,432	1,335	1,289
70%	1,049	1,073	1,187	1,210	1,289	1,269	1,265	1,343	1,276	1,180	1,092	1,043
80%	875	862	919	957	1,020	1,099	1,056	1,121	1,071	1,001	938	907
90%	635	646	646	681	779	803	734	731	835	756	682	639
Long Term												
Full Simulation Period ^b	1,347	1,351	1,382	1,436	1,491	1,541	1,534	1,580	1,595	1,506	1,408	1,353
Water Year Types^c												
Wet (32%)	1,562	1,567	1,618	1,720	1,792	1,871	1,906	2,049	2,146	2,057	1,934	1,855
Above Normal (16%)	1,269	1,295	1,356	1,442	1,530	1,620	1,634	1,713	1,720	1,627	1,529	1,481
Below Normal (13%)	1,530	1,536	1,550	1,570	1,620	1,650	1,614	1,617	1,599	1,501	1,403	1,357
Dry (24%)	1,327	1,320	1,326	1,342	1,378	1,409	1,380	1,360	1,319	1,224	1,137	1,091
Critical (15%)	828	824	836	846	866	860	803	751	719	653	593	563

Alternative 3 minus Second Basis of Comparison

Statistic	End of Month Storage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	9%	10%	8%	5%	1%	0%	2%	3%	10%	12%	13%	11%
20%	15%	15%	15%	13%	7%	5%	6%	3%	14%	12%	14%	14%
30%	10%	9%	11%	14%	13%	13%	9%	7%	8%	8%	9%	10%
40%	16%	16%	13%	14%	14%	12%	11%	14%	11%	12%	13%	14%
50%	19%	17%	15%	15%	13%	12%	13%	14%	14%	15%	16%	17%
60%	20%	20%	17%	13%	13%	11%	8%	11%	16%	17%	18%	18%
70%	10%	9%	14%	12%	17%	15%	10%	14%	11%	11%	11%	11%
80%	23%	21%	26%	27%	24%	18%	16%	19%	19%	20%	24%	27%
90%	25%	25%	25%	23%	17%	21%	21%	18%	20%	22%	25%	26%
Long Term												
Full Simulation Period ^b	13%	13%	13%	12%	11%	10%	9%	10%	12%	13%	13%	13%
Water Year Types^c												
Wet (32%)	8%	8%	8%	7%	5%	4%	4%	4%	8%	7%	7%	7%
Above Normal (16%)	16%	16%	15%	14%	13%	11%	10%	11%	13%	15%	16%	16%
Below Normal (13%)	12%	12%	12%	12%	11%	12%	10%	12%	13%	14%	14%	15%
Dry (24%)	15%	15%	15%	16%	16%	15%	14%	16%	17%	18%	19%	20%
Critical (15%)	24%	24%	24%	24%	24%	25%	24%	28%	29%	31%	32%	32%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.1.4 New Melones Reservoir, End of Month Storage

Second Basis of Comparison

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,801	1,782	1,827	1,875	1,952	2,030	2,017	2,134	2,071	1,977	1,869	1,805
20%	1,657	1,655	1,665	1,690	1,847	1,928	1,884	1,963	1,884	1,830	1,719	1,663
30%	1,575	1,582	1,614	1,627	1,697	1,743	1,751	1,836	1,836	1,743	1,635	1,577
40%	1,366	1,372	1,472	1,556	1,621	1,675	1,649	1,601	1,619	1,510	1,415	1,362
50%	1,200	1,211	1,248	1,348	1,472	1,541	1,484	1,511	1,467	1,357	1,258	1,200
60%	1,089	1,093	1,124	1,209	1,259	1,341	1,373	1,379	1,317	1,224	1,134	1,089
70%	956	989	1,040	1,084	1,099	1,099	1,146	1,179	1,147	1,064	982	940
80%	711	712	730	753	825	932	914	945	903	837	758	712
90%	508	517	515	555	666	664	608	619	697	619	547	507
Long Term												
Full Simulation Period ^b	1,192	1,194	1,226	1,279	1,345	1,397	1,402	1,433	1,420	1,336	1,245	1,194
Water Year Types^c												
Wet (32%)	1,443	1,446	1,502	1,606	1,709	1,794	1,833	1,962	1,994	1,917	1,803	1,731
Above Normal (16%)	1,092	1,116	1,175	1,261	1,360	1,455	1,481	1,543	1,516	1,419	1,321	1,274
Below Normal (13%)	1,364	1,366	1,378	1,397	1,453	1,479	1,461	1,447	1,415	1,322	1,228	1,183
Dry (24%)	1,149	1,143	1,149	1,161	1,191	1,221	1,210	1,176	1,131	1,039	956	912
Critical (15%)	667	663	674	680	696	690	646	585	557	498	449	426

Alternative 5

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,765	1,759	1,831	1,881	1,949	1,969	1,908	2,012	2,117	2,013	1,900	1,826
20%	1,588	1,587	1,601	1,626	1,782	1,794	1,752	1,844	1,816	1,740	1,631	1,571
30%	1,468	1,459	1,490	1,544	1,630	1,672	1,679	1,693	1,721	1,633	1,531	1,489
40%	1,249	1,252	1,347	1,437	1,522	1,573	1,512	1,494	1,505	1,405	1,297	1,242
50%	1,040	1,058	1,142	1,227	1,437	1,455	1,393	1,357	1,289	1,190	1,100	1,074
60%	976	997	1,023	1,072	1,134	1,161	1,159	1,246	1,218	1,130	1,032	983
70%	766	802	855	907	938	973	1,006	978	991	900	821	783
80%	554	553	620	621	623	697	651	721	761	686	617	587
90%	285	298	299	377	429	449	386	452	492	423	349	308
Long Term												
Full Simulation Period ^b	1,063	1,073	1,112	1,169	1,239	1,284	1,265	1,287	1,299	1,221	1,134	1,086
Water Year Types^c												
Wet (32%)	1,309	1,321	1,388	1,496	1,602	1,668	1,704	1,812	1,906	1,833	1,722	1,653
Above Normal (16%)	983	1,014	1,079	1,168	1,271	1,361	1,363	1,413	1,396	1,302	1,207	1,162
Below Normal (13%)	1,210	1,220	1,242	1,267	1,329	1,354	1,298	1,276	1,254	1,163	1,071	1,028
Dry (24%)	1,018	1,018	1,030	1,045	1,081	1,114	1,066	1,031	990	903	823	781
Critical (15%)	558	559	570	578	597	591	506	449	433	391	355	336

Alternative 5 minus Second Basis of Comparison

Statistic	End of Month Storage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-2%	-1%	0%	0%	0%	-3%	-5%	-6%	2%	2%	2%	1%
20%	-4%	-4%	-4%	-4%	-4%	-7%	-7%	-6%	-4%	-5%	-5%	-6%
30%	-7%	-8%	-8%	-5%	-4%	-4%	-4%	-8%	-6%	-6%	-6%	-6%
40%	-9%	-9%	-9%	-8%	-6%	-6%	-8%	-7%	-7%	-8%	-8%	-9%
50%	-13%	-13%	-8%	-9%	-2%	-6%	-6%	-10%	-12%	-12%	-13%	-11%
60%	-10%	-9%	-9%	-11%	-10%	-13%	-16%	-10%	-8%	-8%	-9%	-10%
70%	-20%	-19%	-18%	-16%	-15%	-11%	-12%	-17%	-14%	-15%	-16%	-17%
80%	-22%	-22%	-15%	-17%	-25%	-25%	-29%	-24%	-16%	-18%	-19%	-18%
90%	-44%	-42%	-42%	-32%	-36%	-32%	-36%	-27%	-29%	-32%	-36%	-39%
Long Term												
Full Simulation Period ^b	-11%	-10%	-9%	-9%	-8%	-8%	-10%	-10%	-9%	-9%	-9%	-9%
Water Year Types^c												
Wet (32%)	-9%	-9%	-8%	-7%	-6%	-7%	-7%	-8%	-4%	-4%	-4%	-4%
Above Normal (16%)	-10%	-9%	-8%	-7%	-7%	-6%	-8%	-8%	-8%	-8%	-9%	-9%
Below Normal (13%)	-11%	-11%	-10%	-9%	-9%	-8%	-11%	-12%	-11%	-12%	-13%	-13%
Dry (24%)	-11%	-11%	-10%	-9%	-9%	-9%	-12%	-12%	-12%	-13%	-14%	-14%
Critical (15%)	-16%	-16%	-15%	-15%	-14%	-14%	-22%	-23%	-22%	-21%	-21%	-21%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

5C.3.3.2 New Melones Elevation

Table 5C.3.3.2.1 New Melones Reservoir, End of Month Elevation

No Action Alternative

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,029	1,028	1,035	1,040	1,046	1,050	1,047	1,057	1,059	1,050	1,039	1,033
20%	1,013	1,015	1,017	1,021	1,029	1,032	1,036	1,043	1,040	1,032	1,021	1,016
30%	1,006	1,006	1,008	1,012	1,021	1,025	1,021	1,027	1,031	1,023	1,013	1,008
40%	975	976	995	1,004	1,012	1,014	1,011	1,006	1,006	995	983	976
50%	956	957	960	980	996	1,006	998	997	991	977	965	961
60%	943	946	950	959	966	976	976	984	976	966	953	947
70%	925	928	938	942	945	947	950	952	951	939	928	929
80%	879	881	887	887	897	912	918	924	923	912	897	888
90%	835	836	837	847	857	863	864	867	876	863	850	843
Long Term												
Full Simulation Period ^b	944	945	951	958	968	974	973	976	976	965	954	948
Water Year Types^c												
Wet (32%)	980	982	990	1,004	1,016	1,023	1,026	1,039	1,047	1,040	1,029	1,022
Above Normal (16%)	932	937	945	960	974	986	988	997	996	985	973	897
Below Normal (13%)	968	969	972	975	985	988	985	985	983	972	960	955
Dry (24%)	943	943	944	947	951	957	955	953	948	934	922	915
Critical (15%)	856	856	862	864	870	871	860	848	840	828	818	812

Alternative 1

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,032	1,031	1,035	1,040	1,048	1,055	1,054	1,064	1,058	1,050	1,039	1,033
20%	1,018	1,018	1,019	1,021	1,037	1,045	1,041	1,049	1,041	1,035	1,024	1,019
30%	1,010	1,010	1,014	1,015	1,022	1,027	1,027	1,036	1,036	1,027	1,016	1,010
40%	988	988	999	1,008	1,014	1,020	1,017	1,012	1,014	1,003	994	988
50%	966	968	972	985	999	1,006	1,001	1,003	999	986	974	968
60%	952	952	956	967	974	984	989	989	981	969	957	952
70%	934	939	945	951	953	953	959	963	959	948	938	933
80%	892	892	896	901	915	931	929	933	927	918	902	891
90%	851	852	852	860	883	883	871	873	889	873	859	849
Long Term												
Full Simulation Period ^b	952	953	957	965	974	981	981	984	982	971	959	953
Water Year Types^c												
Wet (32%)	989	990	997	1,009	1,021	1,030	1,034	1,047	1,050	1,043	1,032	1,025
Above Normal (16%)	941	944	951	966	979	992	995	1,003	1,001	990	978	901
Below Normal (13%)	977	977	979	982	991	994	994	993	991	980	968	962
Dry (24%)	951	950	950	953	957	962	963	960	954	941	929	922
Critical (15%)	866	866	870	872	878	879	871	856	850	835	823	817

Alternative 1 minus No Action Alternative

Statistic	End of Month Elevation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	1%	1%	0%	0%	0%	0%
20%	0%	0%	0%	0%	1%	1%	0%	1%	0%	0%	0%	0%
30%	0%	0%	1%	0%	0%	0%	1%	1%	0%	0%	0%	0%
40%	1%	1%	0%	0%	0%	1%	1%	1%	1%	1%	1%	1%
50%	1%	1%	1%	1%	0%	0%	0%	1%	1%	1%	1%	1%
60%	1%	1%	1%	1%	1%	1%	1%	1%	1%	0%	0%	0%
70%	1%	1%	1%	1%	1%	1%	1%	1%	1%	1%	1%	0%
80%	2%	1%	1%	2%	2%	2%	1%	1%	0%	1%	1%	0%
90%	2%	2%	2%	2%	3%	2%	1%	1%	2%	1%	1%	1%
Long Term												
Full Simulation Period ^b	1%	1%	1%	1%	1%	1%	1%	1%	1%	1%	1%	1%
Water Year Types^c												
Wet (32%)	1%	1%	1%	1%	1%	1%	1%	1%	0%	0%	0%	0%
Above Normal (16%)	1%	1%	1%	1%	1%	1%	1%	1%	1%	1%	1%	1%
Below Normal (13%)	1%	1%	1%	1%	1%	1%	1%	1%	1%	1%	1%	1%
Dry (24%)	1%	1%	1%	1%	1%	1%	1%	1%	1%	1%	1%	1%
Critical (15%)	1%	1%	1%	1%	1%	1%	1%	1%	1%	1%	1%	1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.2.2 New Melones Reservoir, End of Month Elevation

Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,032	1,031	1,035	1,040	1,048	1,055	1,054	1,064	1,058	1,050	1,039	1,033
20%	1,018	1,018	1,019	1,021	1,037	1,045	1,041	1,049	1,041	1,035	1,024	1,019
30%	1,010	1,010	1,014	1,015	1,022	1,027	1,027	1,036	1,036	1,027	1,016	1,010
40%	988	988	999	1,008	1,014	1,020	1,017	1,012	1,014	1,003	994	988
50%	966	968	972	985	999	1,006	1,001	1,003	999	986	974	968
60%	952	952	956	967	974	984	989	989	981	969	957	952
70%	934	939	945	951	953	953	959	963	959	948	938	933
80%	892	892	896	901	915	931	929	933	927	918	902	891
90%	851	852	852	860	883	883	871	873	889	873	859	849
Long Term												
Full Simulation Period ^b	952	953	957	965	974	981	981	984	982	971	959	953
Water Year Types^c												
Wet (32%)	989	990	997	1,009	1,021	1,030	1,034	1,047	1,050	1,043	1,032	1,025
Above Normal (16%)	941	944	951	966	979	992	995	1,003	1,001	990	978	901
Below Normal (13%)	977	977	979	982	991	994	994	993	991	980	968	962
Dry (24%)	951	950	950	953	957	962	963	960	954	941	929	922
Critical (15%)	866	866	870	872	878	879	871	856	850	835	823	817

No Action Alternative

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,029	1,028	1,035	1,040	1,046	1,050	1,047	1,057	1,059	1,050	1,039	1,033
20%	1,013	1,015	1,017	1,021	1,029	1,032	1,036	1,043	1,040	1,032	1,021	1,016
30%	1,006	1,006	1,008	1,012	1,021	1,025	1,021	1,027	1,031	1,023	1,013	1,008
40%	975	976	995	1,004	1,012	1,014	1,011	1,006	1,006	995	983	976
50%	956	957	960	980	996	1,006	998	997	991	977	965	961
60%	943	946	950	959	966	976	976	984	976	966	953	947
70%	925	928	938	942	945	947	950	952	951	939	928	929
80%	879	881	887	887	897	912	918	924	923	912	897	888
90%	835	836	837	847	857	863	864	867	876	863	850	843
Long Term												
Full Simulation Period ^b	944	945	951	958	968	974	973	976	976	965	954	948
Water Year Types^c												
Wet (32%)	980	982	990	1,004	1,016	1,023	1,026	1,039	1,047	1,040	1,029	1,022
Above Normal (16%)	932	937	945	960	974	986	988	997	996	985	973	897
Below Normal (13%)	968	969	972	975	985	988	985	985	983	972	960	955
Dry (24%)	943	943	944	947	951	957	955	953	948	934	922	915
Critical (15%)	856	856	862	864	870	871	860	848	840	828	818	812

No Action Alternative minus Second Basis of Comparison

Statistic	End of Month Elevation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	-1%	-1%	0%	0%	0%	0%
20%	0%	0%	0%	0%	-1%	-1%	0%	-1%	0%	0%	0%	0%
30%	0%	0%	-1%	0%	0%	0%	-1%	-1%	0%	0%	0%	0%
40%	-1%	-1%	0%	0%	0%	-1%	-1%	-1%	-1%	-1%	-1%	-1%
50%	-1%	-1%	-1%	-1%	0%	0%	0%	-1%	-1%	-1%	-1%	-1%
60%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	0%	0%	0%
70%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	0%
80%	-2%	-1%	-1%	-2%	-2%	-2%	-1%	-1%	0%	-1%	-1%	0%
90%	-2%	-2%	-2%	-2%	-3%	-2%	-1%	-1%	-2%	-1%	-1%	-1%
Long Term												
Full Simulation Period ^b	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%
Water Year Types^c												
Wet (32%)	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	0%	0%	0%	0%
Above Normal (16%)	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%
Below Normal (13%)	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%
Dry (24%)	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%
Critical (15%)	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.2.3 New Melones Reservoir, End of Month Elevation

Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,032	1,031	1,035	1,040	1,048	1,055	1,054	1,064	1,058	1,050	1,039	1,033
20%	1,018	1,018	1,019	1,021	1,037	1,045	1,041	1,049	1,041	1,035	1,024	1,019
30%	1,010	1,010	1,014	1,015	1,022	1,027	1,027	1,036	1,036	1,027	1,016	1,010
40%	988	988	999	1,008	1,014	1,020	1,017	1,012	1,014	1,003	994	988
50%	966	968	972	985	999	1,006	1,001	1,003	999	986	974	968
60%	952	952	956	967	974	984	989	989	981	969	957	952
70%	934	939	945	951	953	953	959	963	959	948	938	933
80%	892	892	896	901	915	931	929	933	927	918	902	891
90%	851	852	852	860	883	883	871	873	889	873	859	849
Long Term												
Full Simulation Period ^b	952	953	957	965	974	981	981	984	982	971	959	953
Water Year Types^c												
Wet (32%)	989	990	997	1,009	1,021	1,030	1,034	1,047	1,050	1,043	1,032	1,025
Above Normal (16%)	941	944	951	966	979	992	995	1,003	1,001	990	978	901
Below Normal (13%)	977	977	979	982	991	994	994	993	991	980	968	962
Dry (24%)	951	950	950	953	957	962	963	960	954	941	929	922
Critical (15%)	866	866	870	872	878	879	871	856	850	835	823	817

Alternative 3

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,049	1,048	1,050	1,050	1,050	1,055	1,057	1,069	1,076	1,070	1,061	1,052
20%	1,043	1,043	1,044	1,044	1,050	1,054	1,051	1,054	1,065	1,057	1,048	1,043
30%	1,025	1,025	1,031	1,038	1,045	1,050	1,044	1,050	1,051	1,040	1,031	1,027
40%	1,011	1,012	1,019	1,030	1,038	1,041	1,036	1,035	1,032	1,022	1,012	1,007
50%	995	994	996	1,008	1,018	1,024	1,020	1,024	1,020	1,008	998	994
60%	980	981	982	988	995	1,002	1,001	1,005	1,005	995	984	979
70%	946	950	964	967	978	975	974	985	976	963	952	945
80%	924	922	930	934	943	953	947	956	949	940	932	926
90%	877	879	879	886	906	911	897	896	918	901	886	876
Long Term												
Full Simulation Period ^b	974	974	978	985	993	999	998	1,002	1,003	992	981	975
Water Year Types^c												
Wet (32%)	1,003	1,004	1,010	1,022	1,030	1,038	1,042	1,055	1,064	1,056	1,045	1,037
Above Normal (16%)	964	967	974	987	999	1,009	1,012	1,021	1,022	1,013	1,002	924
Below Normal (13%)	998	998	1,000	1,002	1,011	1,014	1,011	1,012	1,010	1,000	989	983
Dry (24%)	974	973	974	977	981	985	983	982	978	966	954	948
Critical (15%)	899	899	902	904	909	909	899	889	883	870	858	852

Alternative 3 minus Second Basis of Comparison

Statistic	End of Month Elevation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2%	2%	1%	1%	0%	0%	0%	1%	2%	2%	2%	2%
20%	2%	2%	2%	2%	1%	1%	1%	0%	2%	2%	2%	2%
30%	2%	1%	2%	2%	2%	2%	2%	1%	1%	1%	1%	2%
40%	2%	2%	2%	2%	2%	2%	2%	2%	2%	2%	2%	2%
50%	3%	3%	2%	2%	2%	2%	2%	2%	2%	2%	3%	3%
60%	3%	3%	3%	2%	2%	2%	1%	2%	2%	3%	3%	3%
70%	1%	1%	2%	2%	3%	2%	2%	2%	2%	2%	2%	1%
80%	4%	3%	4%	4%	3%	2%	2%	2%	2%	2%	3%	4%
90%	3%	3%	3%	3%	3%	3%	3%	3%	3%	3%	3%	3%
Long Term												
Full Simulation Period ^b	2%	2%	2%	2%	2%	2%	2%	2%	2%	2%	2%	2%
Water Year Types^c												
Wet (32%)	1%	1%	1%	1%	1%	1%	1%	1%	1%	1%	1%	1%
Above Normal (16%)	2%	2%	2%	2%	2%	2%	2%	2%	2%	2%	2%	3%
Below Normal (13%)	2%	2%	2%	2%	2%	2%	2%	2%	2%	2%	2%	2%
Dry (24%)	2%	2%	2%	2%	3%	2%	2%	2%	3%	3%	3%	3%
Critical (15%)	4%	4%	4%	4%	3%	3%	3%	4%	4%	4%	4%	4%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.2.4 New Melones Reservoir, End of Month Elevation

Second Basis of Comparison

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,032	1,031	1,035	1,040	1,048	1,055	1,054	1,064	1,058	1,050	1,039	1,033
20%	1,018	1,018	1,019	1,021	1,037	1,045	1,041	1,049	1,041	1,035	1,024	1,019
30%	1,010	1,010	1,014	1,015	1,022	1,027	1,027	1,036	1,036	1,027	1,016	1,010
40%	988	988	999	1,008	1,014	1,020	1,017	1,012	1,014	1,003	994	988
50%	966	968	972	985	999	1,006	1,001	1,003	999	986	974	968
60%	952	952	956	967	974	984	989	989	981	969	957	952
70%	934	939	945	951	953	953	959	963	959	948	938	933
80%	892	892	896	901	915	931	929	933	927	918	902	891
90%	851	852	852	860	883	883	871	873	889	873	859	849
Long Term												
Full Simulation Period ^b	952	953	957	965	974	981	981	984	982	971	959	953
Water Year Types^c												
Wet (32%)	989	990	997	1,009	1,021	1,030	1,034	1,047	1,050	1,043	1,032	1,025
Above Normal (16%)	941	944	951	966	979	992	995	1,003	1,001	990	978	901
Below Normal (13%)	977	977	979	982	991	994	994	993	991	980	968	962
Dry (24%)	951	950	950	953	957	962	963	960	954	941	929	922
Critical (15%)	866	866	870	872	878	879	871	856	850	835	823	817

Alternative 5

Statistic	End of Month Elevation (Feet)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,029	1,028	1,036	1,041	1,047	1,049	1,043	1,053	1,062	1,053	1,043	1,035
20%	1,011	1,011	1,012	1,015	1,031	1,032	1,028	1,037	1,034	1,026	1,015	1,009
30%	999	998	1,001	1,007	1,015	1,019	1,020	1,022	1,024	1,016	1,005	1,002
40%	973	973	985	996	1,004	1,010	1,003	1,002	1,003	992	979	973
50%	945	948	959	970	996	998	991	987	978	965	953	951
60%	937	940	943	949	957	961	961	972	968	957	944	938
70%	904	911	921	928	932	936	941	937	939	927	915	909
80%	860	860	874	874	874	889	880	894	902	887	873	867
90%	803	807	808	824	834	838	826	839	847	833	818	810
Long Term												
Full Simulation Period ^b	931	933	939	947	957	964	961	962	963	952	941	935
Water Year Types^c												
Wet (32%)	969	971	980	995	1,007	1,016	1,020	1,031	1,040	1,033	1,022	1,015
Above Normal (16%)	924	930	939	954	968	980	982	988	987	975	963	890
Below Normal (13%)	954	956	959	962	973	977	972	970	968	957	944	938
Dry (24%)	930	930	932	934	939	945	940	936	931	918	905	898
Critical (15%)	837	838	842	845	853	855	834	818	815	804	796	791

Alternative 5 minus Second Basis of Comparison

Statistic	End of Month Elevation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	-1%	-1%	0%	0%	0%	0%
20%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%
30%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%
40%	-2%	-2%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-2%
50%	-2%	-2%	-1%	-2%	0%	-1%	-1%	-2%	-2%	-2%	-2%	-2%
60%	-2%	-1%	-1%	-2%	-2%	-2%	-3%	-2%	-1%	-1%	-1%	-1%
70%	-3%	-3%	-3%	-2%	-2%	-2%	-2%	-3%	-2%	-2%	-2%	-3%
80%	-4%	-4%	-3%	-3%	-4%	-4%	-5%	-4%	-3%	-3%	-3%	-3%
90%	-6%	-5%	-5%	-4%	-6%	-5%	-5%	-4%	-5%	-5%	-5%	-5%
Long Term												
Full Simulation Period ^b	-2%	-2%	-2%	-2%	-2%	-2%	-2%	-2%	-2%	-2%	-2%	-2%
Water Year Types^c												
Wet (32%)	-2%	-2%	-2%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%
Above Normal (16%)	-2%	-2%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-1%	-2%	-1%
Below Normal (13%)	-2%	-2%	-2%	-2%	-2%	-2%	-2%	-2%	-2%	-2%	-2%	-2%
Dry (24%)	-2%	-2%	-2%	-2%	-2%	-2%	-2%	-2%	-2%	-3%	-3%	-3%
Critical (15%)	-3%	-3%	-3%	-3%	-3%	-3%	-4%	-4%	-4%	-4%	-3%	-3%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

5C.3.3.3 Stanislaus River below Goodwin Dam Flow

Table 5C.3.3.3.1 Stanislaus River below Goodwin, Monthly Flow

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	837	290	306	358	897	1,648	1,633	1,929	1,103	429	390	390
20%	797	200	218	232	409	1,521	1,553	1,555	1,090	310	300	300
30%	774	200	200	232	290	440	1,553	1,296	940	300	284	250
40%	774	200	200	226	236	200	1,400	1,242	855	300	283	250
50%	774	200	200	226	236	200	1,400	1,242	363	271	283	250
60%	636	200	200	219	229	200	812	918	363	265	283	249
70%	636	200	200	219	229	200	767	705	297	265	283	249
80%	578	200	200	214	221	200	767	631	261	265	283	249
90%	577	200	200	213	215	200	505	546	255	265	283	249
Long Term												
Full Simulation Period ^b	723	278	365	518	595	754	1,158	1,123	680	394	361	351
Water Year Types ^c												
Wet (23%)	781	499	787	999	1,201	2,016	1,536	1,691	1,140	715	639	692
Above Normal (24%)	714	216	282	663	676	645	1,224	1,146	962	353	292	267
Below Normal (10%)	740	225	225	282	346	365	1,454	1,201	476	269	285	256
Dry (16%)	707	208	216	234	313	200	1,030	930	374	275	277	245
Critical (27%)	683	205	215	227	255	234	741	699	281	269	262	231

Alternative 1

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	350	499	508	508	907	709	1,500	1,500	2,887	360	300	300
20%	350	415	415	415	503	415	1,462	1,500	1,709	306	300	300
30%	331	386	415	408	415	415	1,337	1,434	1,571	300	296	268
40%	286	318	326	318	415	318	991	1,303	845	300	283	268
50%	286	318	318	318	318	318	664	1,303	450	284	283	268
60%	194	247	275	242	318	275	512	1,112	398	268	283	249
70%	194	247	247	242	260	242	461	920	289	268	283	249
80%	173	233	247	242	242	242	424	848	257	265	283	249
90%	164	230	230	200	239	200	378	760	255	265	283	249
Long Term												
Full Simulation Period ^b	291	388	466	584	642	607	884	1,181	1,028	390	347	363
Water Year Types ^c												
Wet (23%)	360	612	886	1,060	1,196	1,462	1,488	1,497	2,316	678	580	731
Above Normal (24%)	301	332	376	726	742	523	940	1,225	1,200	354	288	271
Below Normal (10%)	288	373	373	383	418	316	955	1,266	613	272	285	270
Dry (16%)	278	323	331	318	392	262	581	1,094	399	276	283	255
Critical (27%)	230	287	298	275	303	256	464	890	280	283	259	228

Alternative 1 minus No Action Alternative

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-58%	72%	66%	42%	1%	-57%	-8%	-22%	162%	-16%	-23%	-23%
20%	-56%	107%	90%	79%	23%	-73%	-6%	-4%	57%	-1%	0%	0%
30%	-57%	93%	107%	76%	43%	-6%	-14%	11%	67%	0%	4%	7%
40%	-63%	59%	63%	41%	76%	59%	-29%	5%	-1%	0%	0%	7%
50%	-63%	59%	59%	41%	35%	59%	-53%	5%	24%	5%	0%	7%
60%	-69%	23%	38%	10%	39%	38%	-37%	21%	10%	1%	0%	0%
70%	-69%	23%	23%	10%	14%	21%	-40%	30%	-3%	1%	0%	0%
80%	-70%	17%	23%	13%	9%	21%	-45%	35%	-2%	0%	0%	0%
90%	-72%	15%	15%	-6%	11%	0%	-25%	39%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	-60%	39%	28%	13%	8%	-19%	-24%	5%	51%	-1%	-4%	3%
Water Year Types ^c												
Wet (23%)	-54%	23%	13%	6%	0%	-27%	-3%	-12%	103%	-5%	-9%	6%
Above Normal (24%)	-58%	54%	33%	10%	10%	-19%	-23%	7%	25%	0%	-1%	1%
Below Normal (10%)	-61%	66%	66%	36%	21%	-14%	-34%	5%	29%	1%	0%	5%
Dry (16%)	-61%	55%	53%	36%	25%	31%	-44%	18%	7%	0%	2%	4%
Critical (27%)	-66%	40%	39%	22%	19%	10%	-37%	27%	0%	5%	-1%	-1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.3.3.2 Stanislaus River below Goodwin, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	350	499	508	508	907	709	1,500	1,500	2,887	360	300	300
20%	350	415	415	415	503	415	1,462	1,500	1,709	306	300	300
30%	331	386	415	408	415	415	1,337	1,434	1,571	300	296	268
40%	286	318	326	318	415	318	991	1,303	845	300	283	268
50%	286	318	318	318	318	318	664	1,303	450	284	283	268
60%	194	247	275	242	318	275	512	1,112	398	268	283	249
70%	194	247	247	242	260	242	461	920	289	268	283	249
80%	173	233	247	242	242	242	424	848	257	265	283	249
90%	164	230	230	200	239	200	378	760	255	265	283	249
Long Term												
Full Simulation Period ^b	291	388	466	584	642	607	884	1,181	1,028	390	347	363
Water Year Types^c												
Wet (23%)	360	612	886	1,060	1,196	1,462	1,488	1,497	2,316	678	580	731
Above Normal (24%)	301	332	376	726	742	523	940	1,225	1,200	354	288	271
Below Normal (10%)	288	373	373	383	418	316	955	1,266	613	272	285	270
Dry (16%)	278	323	331	318	392	262	581	1,094	399	276	283	255
Critical (27%)	230	287	298	275	303	256	464	890	280	283	259	228

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	837	290	306	358	897	1,648	1,633	1,929	1,103	429	390	390
20%	797	200	218	232	409	1,521	1,553	1,555	1,090	310	300	300
30%	774	200	200	232	290	440	1,553	1,296	940	300	284	250
40%	774	200	200	226	236	200	1,400	1,242	855	300	283	250
50%	774	200	200	226	236	200	1,400	1,242	363	271	283	250
60%	636	200	200	219	229	200	812	918	363	265	283	249
70%	636	200	200	219	229	200	767	705	297	265	283	249
80%	578	200	200	214	221	200	767	631	261	265	283	249
90%	577	200	200	213	215	200	505	546	255	265	283	249
Long Term												
Full Simulation Period ^b	723	278	365	518	595	754	1,158	1,123	680	394	361	351
Water Year Types^c												
Wet (23%)	781	499	787	999	1,201	2,016	1,536	1,691	1,140	715	639	692
Above Normal (24%)	714	216	282	663	676	645	1,224	1,146	962	353	292	267
Below Normal (10%)	740	225	225	282	346	365	1,454	1,201	476	269	285	256
Dry (16%)	707	208	216	234	313	200	1,030	930	374	275	277	245
Critical (27%)	683	205	215	227	255	234	741	699	281	269	262	231

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	139%	-42%	-40%	-30%	-1%	132%	9%	29%	-62%	19%	30%	30%
20%	128%	-52%	-47%	-44%	-19%	267%	6%	4%	-36%	1%	0%	0%
30%	134%	-48%	-52%	-43%	-30%	6%	16%	-10%	-40%	0%	-4%	-7%
40%	170%	-37%	-39%	-29%	-43%	-37%	41%	-5%	1%	0%	0%	-7%
50%	170%	-37%	-37%	-29%	-26%	-37%	111%	-5%	-19%	-5%	0%	-7%
60%	227%	-19%	-27%	-9%	-28%	-27%	59%	-17%	-9%	-1%	0%	0%
70%	227%	-19%	-19%	-9%	-12%	-17%	66%	-23%	3%	-1%	0%	0%
80%	234%	-14%	-19%	-12%	-9%	-17%	81%	-26%	2%	0%	0%	0%
90%	252%	-13%	-13%	6%	-10%	0%	34%	-28%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	149%	-28%	-22%	-11%	-7%	24%	31%	-5%	-34%	1%	4%	-3%
Water Year Types^c												
Wet (23%)	117%	-19%	-11%	-6%	0%	38%	3%	13%	-51%	5%	10%	-5%
Above Normal (24%)	137%	-35%	-25%	-9%	-9%	23%	30%	-6%	-20%	0%	1%	-1%
Below Normal (10%)	157%	-40%	-40%	-26%	-17%	16%	52%	-5%	-22%	-1%	0%	-5%
Dry (16%)	154%	-36%	-35%	-26%	-20%	-24%	77%	-15%	-6%	0%	-2%	-4%
Critical (27%)	197%	-29%	-28%	-18%	-16%	-9%	60%	-22%	0%	-5%	1%	1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.3.3.3 Stanislaus River below Goodwin, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	350	499	508	508	907	709	1,500	1,500	2,887	360	300	300
20%	350	415	415	415	503	415	1,462	1,500	1,709	306	300	300
30%	331	386	415	408	415	415	1,337	1,434	1,571	300	296	268
40%	286	318	326	318	415	318	991	1,303	845	300	283	268
50%	286	318	318	318	318	318	664	1,303	450	284	283	268
60%	194	247	275	242	318	275	512	1,112	398	268	283	249
70%	194	247	247	242	260	242	461	920	289	268	283	249
80%	173	233	247	242	242	242	424	848	257	265	283	249
90%	164	230	230	200	239	200	378	760	255	265	283	249
Long Term												
Full Simulation Period ^b	291	388	466	584	642	607	884	1,181	1,028	390	347	363
Water Year Types^c												
Wet (23%)	360	612	886	1,060	1,196	1,462	1,488	1,497	2,316	678	580	731
Above Normal (24%)	301	332	376	726	742	523	940	1,225	1,200	354	288	271
Below Normal (10%)	288	373	373	383	418	316	955	1,266	613	272	285	270
Dry (16%)	278	323	331	318	392	262	581	1,094	399	276	283	255
Critical (27%)	230	287	298	275	303	256	464	890	280	283	259	228

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	300	300	609	1,135	2,548	1,189	1,500	1,165	255	265	283	952
20%	300	300	305	300	1,157	344	1,500	1,165	255	265	283	249
30%	300	300	300	300	333	300	1,500	1,165	255	265	283	249
40%	252	300	300	300	300	300	1,034	963	255	265	283	249
50%	252	300	300	150	176	200	893	829	255	265	283	249
60%	252	300	300	150	173	200	893	829	255	265	283	249
70%	252	300	300	150	173	200	893	829	255	265	283	249
80%	200	200	220	150	173	200	528	466	255	265	283	249
90%	200	200	200	150	173	200	493	466	255	265	283	249
Long Term												
Full Simulation Period ^b	302	349	475	557	814	622	1,060	911	490	421	391	397
Water Year Types^c												
Wet (23%)	368	589	1,001	1,066	2,016	1,599	1,538	1,300	1,279	952	768	885
Above Normal (24%)	323	287	394	705	732	552	1,155	955	255	265	283	260
Below Normal (10%)	269	275	275	483	552	272	1,128	909	255	265	283	249
Dry (16%)	285	285	293	251	371	200	815	730	255	265	283	249
Critical (27%)	246	264	274	191	208	218	680	643	245	254	268	240

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-14%	-40%	20%	123%	181%	68%	0%	-22%	-91%	-26%	-6%	217%
20%	-14%	-28%	-27%	-28%	130%	-17%	3%	-22%	-85%	-13%	-6%	-17%
30%	-9%	-22%	-28%	-27%	-20%	-28%	12%	-19%	-84%	-12%	-4%	-7%
40%	-12%	-6%	-8%	-6%	-28%	-6%	4%	-26%	-70%	-12%	0%	-7%
50%	-12%	-6%	-6%	-53%	-45%	-37%	35%	-36%	-43%	-7%	0%	-7%
60%	30%	22%	9%	-38%	-46%	-27%	74%	-25%	-36%	-1%	0%	0%
70%	30%	22%	22%	-38%	-33%	-17%	94%	-10%	-12%	-1%	0%	0%
80%	15%	-14%	-11%	-38%	-29%	-17%	25%	-45%	0%	0%	0%	0%
90%	22%	-13%	-13%	-25%	-28%	0%	31%	-39%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	4%	-10%	2%	-5%	27%	2%	20%	-23%	-52%	8%	13%	9%
Water Year Types^c												
Wet (23%)	2%	-4%	13%	1%	69%	9%	3%	-13%	-45%	40%	33%	21%
Above Normal (24%)	7%	-13%	5%	-3%	-1%	5%	23%	-22%	-79%	-25%	-2%	-4%
Below Normal (10%)	-7%	-26%	-26%	26%	32%	-14%	18%	-28%	-58%	-2%	-1%	-8%
Dry (16%)	3%	-12%	-12%	-21%	-5%	-24%	40%	-33%	-36%	-4%	0%	-2%
Critical (27%)	7%	-8%	-8%	-31%	-31%	-15%	47%	-28%	-12%	-10%	3%	5%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.3.3.4 Stanislaus River below Goodwin, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	350	499	508	508	907	709	1,500	1,500	2,887	360	300	300
20%	350	415	415	415	503	415	1,462	1,500	1,709	306	300	300
30%	331	386	415	408	415	415	1,337	1,434	1,571	300	296	268
40%	286	318	326	318	415	318	991	1,303	845	300	283	268
50%	286	318	318	318	318	318	664	1,303	450	284	283	268
60%	194	247	275	242	318	275	512	1,112	398	268	283	249
70%	194	247	247	242	260	242	461	920	289	268	283	249
80%	173	233	247	242	242	242	424	848	257	265	283	249
90%	164	230	230	200	239	200	378	760	255	265	283	249
Long Term												
Full Simulation Period ^b	291	388	466	584	642	607	884	1,181	1,028	390	347	363
Water Year Types^c												
Wet (23%)	360	612	886	1,060	1,196	1,462	1,488	1,497	2,316	678	580	731
Above Normal (24%)	301	332	376	726	742	523	940	1,225	1,200	354	288	271
Below Normal (10%)	288	373	373	383	418	316	955	1,266	613	272	285	270
Dry (16%)	278	323	331	318	392	262	581	1,094	399	276	283	255
Critical (27%)	230	287	298	275	303	256	464	890	280	283	259	228

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	797	200	306	358	885	1,636	1,717	1,958	1,103	423	300	300
20%	797	200	211	232	415	1,521	1,633	1,815	979	307	300	300
30%	774	200	200	232	274	343	1,553	1,595	940	300	283	250
40%	774	200	200	226	236	200	1,487	1,555	759	297	283	250
50%	636	200	200	226	236	200	1,400	1,341	363	265	283	249
60%	636	200	200	219	229	200	1,324	1,242	342	265	283	249
70%	636	200	200	219	222	200	1,134	1,068	270	265	283	249
80%	577	200	200	213	221	200	825	887	255	265	283	249
90%	577	200	200	213	214	200	767	798	255	265	283	249
Long Term												
Full Simulation Period ^b	711	276	345	520	580	712	1,317	1,375	660	369	332	341
Water Year Types^c												
Wet (23%)	766	499	690	998	1,169	1,831	1,502	1,730	1,093	619	523	655
Above Normal (24%)	705	211	298	676	659	645	1,170	1,553	962	353	292	267
Below Normal (10%)	733	225	225	281	345	365	1,416	1,267	462	269	285	256
Dry (16%)	690	208	216	233	312	200	1,454	1,370	366	275	277	245
Critical (27%)	674	200	210	221	242	234	1,175	948	257	260	253	224

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	128%	-60%	-40%	-30%	-2%	131%	14%	31%	-62%	18%	0%	0%
20%	128%	-52%	-49%	-44%	-17%	267%	12%	21%	-43%	0%	0%	0%
30%	134%	-48%	-52%	-43%	-34%	-17%	16%	11%	-40%	0%	-4%	-7%
40%	170%	-37%	-39%	-29%	-43%	-37%	50%	19%	-10%	-1%	0%	-7%
50%	122%	-37%	-37%	-29%	-26%	-37%	111%	3%	-19%	-7%	0%	-7%
60%	227%	-19%	-27%	-9%	-28%	-27%	159%	12%	-14%	-1%	0%	0%
70%	227%	-19%	-19%	-9%	-15%	-17%	146%	16%	-7%	-1%	0%	0%
80%	233%	-14%	-19%	-12%	-9%	-17%	95%	5%	0%	0%	0%	0%
90%	252%	-13%	-13%	6%	-11%	0%	103%	5%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	145%	-29%	-26%	-11%	-10%	17%	49%	16%	-36%	-5%	-4%	-6%
Water Year Types^c												
Wet (23%)	113%	-19%	-22%	-6%	-2%	25%	1%	16%	-53%	-9%	-10%	-10%
Above Normal (24%)	134%	-36%	-21%	-7%	-11%	23%	24%	27%	-20%	0%	1%	-1%
Below Normal (10%)	155%	-40%	-40%	-27%	-17%	16%	48%	0%	-25%	-1%	0%	-5%
Dry (16%)	148%	-36%	-35%	-27%	-20%	-24%	150%	25%	-8%	0%	-2%	-4%
Critical (27%)	194%	-30%	-29%	-20%	-20%	-9%	153%	7%	-8%	-8%	-2%	-2%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

5C.3.3.4 Stanislaus River at Mouth Flow

Table 5C.3.3.4.1 Stanislaus River at Mouth, Monthly Flow

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,122	463	442	576	1,084	1,969	1,886	1,989	1,536	751	587	646
20%	1,029	384	368	427	643	1,708	1,769	1,647	1,334	606	488	507
30%	982	348	319	368	472	520	1,696	1,536	1,221	502	462	473
40%	958	337	304	347	406	433	1,610	1,362	1,053	442	445	443
50%	879	319	290	337	369	367	1,485	1,289	635	412	445	439
60%	826	292	281	326	331	336	936	873	510	383	416	428
70%	772	267	262	312	279	314	806	755	406	372	395	389
80%	755	260	241	295	253	241	686	646	358	341	371	360
90%	676	248	224	273	230	207	572	576	311	308	331	318
Long Term												
Full Simulation Period ^b	903	398	448	630	719	903	1,279	1,207	883	546	505	533
Water Year Types^c												
Wet (23%)	952	624	881	1,115	1,412	2,258	1,779	1,828	1,456	976	831	946
Above Normal (24%)	907	347	357	776	786	801	1,410	1,244	1,257	534	467	480
Below Normal (10%)	932	354	358	430	517	539	1,556	1,378	669	449	440	429
Dry (16%)	916	322	300	349	405	345	1,064	1,002	530	375	397	399
Critical (27%)	837	310	277	317	319	286	754	695	335	321	346	342

Alternative 1

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	662	653	656	688	1,117	1,153	1,804	1,679	3,009	661	569	673
20%	582	548	522	557	694	613	1,608	1,592	2,016	555	485	508
30%	507	492	464	518	562	562	1,489	1,533	1,772	502	461	481
40%	471	459	427	473	512	522	1,040	1,423	1,092	444	445	457
50%	405	421	378	412	484	446	821	1,331	694	412	443	439
60%	377	388	341	364	423	394	637	1,049	572	386	416	431
70%	346	355	329	339	331	361	529	972	402	378	395	396
80%	327	312	311	318	296	295	440	865	352	350	373	373
90%	249	280	269	283	257	233	406	787	312	318	331	316
Long Term												
Full Simulation Period ^b	471	507	549	696	766	756	1,004	1,265	1,231	542	491	545
Water Year Types^c												
Wet (23%)	530	737	980	1,176	1,407	1,704	1,731	1,634	2,632	939	772	985
Above Normal (24%)	494	463	451	840	852	680	1,126	1,323	1,495	535	463	484
Below Normal (10%)	480	503	506	532	589	489	1,057	1,443	807	452	440	443
Dry (16%)	487	437	415	433	484	407	616	1,166	555	377	404	408
Critical (27%)	384	393	360	366	367	309	476	887	334	335	343	338

Alternative 1 minus No Action Alternative

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-41%	41%	48%	19%	3%	-41%	-4%	-16%	96%	-12%	-3%	4%
20%	-43%	43%	42%	31%	8%	-64%	-9%	-3%	51%	-8%	-1%	0%
30%	-48%	42%	46%	41%	19%	8%	-12%	0%	45%	0%	0%	2%
40%	-51%	36%	40%	36%	26%	21%	-35%	4%	4%	0%	0%	3%
50%	-54%	32%	30%	22%	31%	22%	-45%	3%	9%	0%	0%	0%
60%	-54%	33%	22%	12%	28%	17%	-32%	20%	12%	1%	0%	1%
70%	-55%	33%	26%	9%	19%	15%	-34%	29%	-1%	1%	0%	2%
80%	-57%	20%	29%	8%	17%	22%	-36%	34%	-2%	3%	1%	3%
90%	-63%	13%	20%	3%	12%	12%	-29%	37%	0%	3%	0%	-1%
Long Term												
Full Simulation Period ^b	-48%	28%	23%	10%	7%	-16%	-21%	5%	39%	-1%	-3%	2%
Water Year Types^c												
Wet (23%)	-44%	18%	11%	5%	0%	-25%	-3%	-11%	81%	-4%	-7%	4%
Above Normal (24%)	-46%	33%	26%	8%	8%	-15%	-20%	6%	19%	0%	-1%	1%
Below Normal (10%)	-49%	42%	41%	24%	14%	-9%	-32%	5%	21%	1%	0%	3%
Dry (16%)	-47%	36%	38%	24%	19%	18%	-42%	16%	5%	0%	2%	2%
Critical (27%)	-54%	27%	30%	15%	15%	8%	-37%	28%	0%	4%	-1%	-1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.3.4.2 Stanislaus River at Mouth, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	662	653	656	688	1,117	1,153	1,804	1,679	3,009	661	569	673
20%	582	548	522	557	694	613	1,608	1,592	2,016	555	485	508
30%	507	492	464	518	562	562	1,489	1,533	1,772	502	461	481
40%	471	459	427	473	512	522	1,040	1,423	1,092	444	445	457
50%	405	421	378	412	484	446	821	1,331	694	412	443	439
60%	377	388	341	364	423	394	637	1,049	572	386	416	431
70%	346	355	329	339	331	361	529	972	402	378	395	396
80%	327	312	311	318	296	295	440	865	352	350	373	373
90%	249	280	269	283	257	233	406	787	312	318	331	316
Long Term												
Full Simulation Period ^b	471	507	549	696	766	756	1,004	1,265	1,231	542	491	545
Water Year Types^c												
Wet (23%)	530	737	980	1,176	1,407	1,704	1,731	1,634	2,632	939	772	985
Above Normal (24%)	494	463	451	840	852	680	1,126	1,323	1,495	535	463	484
Below Normal (10%)	480	503	506	532	589	489	1,057	1,443	807	452	440	443
Dry (16%)	487	437	415	433	484	407	616	1,166	555	377	404	408
Critical (27%)	384	393	360	366	367	309	476	887	334	335	343	338

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,122	463	442	576	1,084	1,969	1,886	1,989	1,536	751	587	646
20%	1,029	384	368	427	643	1,708	1,769	1,647	1,334	606	488	507
30%	982	348	319	368	472	520	1,696	1,536	1,221	502	462	473
40%	958	337	304	347	406	433	1,610	1,362	1,053	442	445	443
50%	879	319	290	337	369	367	1,485	1,289	635	412	445	439
60%	826	292	281	326	331	336	936	873	510	383	416	428
70%	772	267	262	312	279	314	806	755	406	372	395	389
80%	755	260	241	295	253	241	686	646	358	341	371	360
90%	676	248	224	273	230	207	572	576	311	308	331	318
Long Term												
Full Simulation Period ^b	903	398	448	630	719	903	1,279	1,207	883	546	505	533
Water Year Types^c												
Wet (23%)	952	624	881	1,115	1,412	2,258	1,779	1,828	1,456	976	831	946
Above Normal (24%)	907	347	357	776	786	801	1,410	1,244	1,257	534	467	480
Below Normal (10%)	932	354	358	430	517	539	1,556	1,378	669	449	440	429
Dry (16%)	916	322	300	349	405	345	1,064	1,002	530	375	397	399
Critical (27%)	837	310	277	317	319	286	754	695	335	321	346	342

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	70%	-29%	-33%	-16%	-3%	71%	5%	19%	-49%	14%	3%	-4%
20%	77%	-30%	-30%	-23%	-7%	178%	10%	3%	-34%	9%	1%	0%
30%	94%	-29%	-31%	-29%	-16%	-8%	14%	0%	-31%	0%	0%	-2%
40%	104%	-27%	-29%	-26%	-21%	-17%	55%	-4%	-4%	0%	0%	-3%
50%	117%	-24%	-23%	-18%	-24%	-18%	81%	-3%	-8%	0%	1%	0%
60%	119%	-25%	-18%	-10%	-22%	-15%	47%	-17%	-11%	-1%	0%	-1%
70%	123%	-25%	-20%	-8%	-16%	-13%	52%	-22%	1%	-1%	0%	-2%
80%	130%	-17%	-22%	-7%	-14%	-18%	56%	-25%	2%	-3%	-1%	-3%
90%	172%	-12%	-17%	-3%	-10%	-11%	41%	-27%	0%	-3%	0%	1%
Long Term												
Full Simulation Period ^b	92%	-22%	-18%	-9%	-6%	19%	27%	-5%	-28%	1%	3%	-2%
Water Year Types^c												
Wet (23%)	79%	-15%	-10%	-5%	0%	33%	3%	12%	-45%	4%	8%	-4%
Above Normal (24%)	84%	-25%	-21%	-8%	-8%	18%	25%	-6%	-16%	0%	1%	-1%
Below Normal (10%)	94%	-29%	-29%	-19%	-12%	10%	47%	-4%	-17%	-1%	0%	-3%
Dry (16%)	88%	-26%	-28%	-19%	-16%	-15%	73%	-14%	-5%	0%	-2%	-2%
Critical (27%)	118%	-21%	-23%	-13%	-13%	-7%	58%	-22%	0%	-4%	1%	1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.3.4.3 Stanislaus River at Mouth, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	662	653	656	688	1,117	1,153	1,804	1,679	3,009	661	569	673
20%	582	548	522	557	694	613	1,608	1,592	2,016	555	485	508
30%	507	492	464	518	562	562	1,489	1,533	1,772	502	461	481
40%	471	459	427	473	512	522	1,040	1,423	1,092	444	445	457
50%	405	421	378	412	484	446	821	1,331	694	412	443	439
60%	377	388	341	364	423	394	637	1,049	572	386	416	431
70%	346	355	329	339	331	361	529	972	402	378	395	396
80%	327	312	311	318	296	295	440	865	352	350	373	373
90%	249	280	269	283	257	233	406	787	312	318	331	316
Long Term												
Full Simulation Period ^b	471	507	549	696	766	756	1,004	1,265	1,231	542	491	545
Water Year Types^c												
Wet (23%)	530	737	980	1,176	1,407	1,704	1,731	1,634	2,632	939	772	985
Above Normal (24%)	494	463	451	840	852	680	1,126	1,323	1,495	535	463	484
Below Normal (10%)	480	503	506	532	589	489	1,057	1,443	807	452	440	443
Dry (16%)	487	437	415	433	484	407	616	1,166	555	377	404	408
Critical (27%)	384	393	360	366	367	309	476	887	334	335	343	338

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	679	485	722	1,267	2,628	1,444	1,865	1,414	950	885	571	1,146
20%	557	456	438	518	1,301	734	1,634	1,306	679	535	480	489
30%	482	441	411	410	502	486	1,552	1,233	558	476	457	450
40%	448	424	400	374	416	419	1,240	1,043	428	424	445	439
50%	435	402	381	311	366	367	1,064	920	413	382	440	435
60%	392	372	362	275	308	334	996	882	374	374	410	415
70%	377	359	325	251	238	312	893	829	352	350	390	384
80%	360	333	300	232	201	238	575	550	304	327	367	360
90%	293	260	239	198	180	203	493	489	273	290	347	320
Long Term												
Full Simulation Period ^b	482	469	558	669	938	770	1,180	995	693	573	535	578
Water Year Types^c												
Wet (23%)	539	714	1,096	1,183	2,227	1,841	1,781	1,437	1,596	1,213	961	1,139
Above Normal (24%)	516	418	468	818	843	708	1,341	1,054	550	446	457	473
Below Normal (10%)	461	404	408	632	723	446	1,230	1,086	449	445	438	422
Dry (16%)	495	399	377	365	463	345	849	803	411	365	404	402
Critical (27%)	401	369	336	282	272	271	692	639	299	305	351	351

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3%	-26%	10%	84%	135%	25%	3%	-16%	-68%	34%	0%	70%
20%	-4%	-17%	-16%	-7%	87%	20%	2%	-18%	-66%	-4%	-1%	-4%
30%	-5%	-10%	-12%	-21%	-11%	-14%	4%	-20%	-68%	-5%	-1%	-7%
40%	-5%	-8%	-6%	-21%	-19%	-20%	19%	-27%	-61%	-5%	0%	-4%
50%	7%	-5%	1%	-24%	-25%	-18%	30%	-31%	-41%	-7%	-1%	-1%
60%	4%	-4%	6%	-24%	-27%	-15%	56%	-16%	-35%	-3%	-1%	-4%
70%	9%	1%	-1%	-26%	-28%	-14%	69%	-15%	-12%	-7%	-1%	-3%
80%	10%	7%	-4%	-27%	-32%	-19%	31%	-36%	-14%	-6%	-1%	-3%
90%	18%	-7%	-11%	-30%	-30%	-13%	21%	-38%	-13%	-9%	5%	1%
Long Term												
Full Simulation Period ^b	2%	-8%	2%	-4%	22%	2%	18%	-21%	-44%	6%	9%	6%
Water Year Types^c												
Wet (23%)	2%	-3%	12%	1%	58%	8%	3%	-12%	-39%	29%	24%	16%
Above Normal (24%)	4%	-10%	4%	-3%	-1%	4%	19%	-20%	-63%	-17%	-1%	-2%
Below Normal (10%)	-4%	-20%	-19%	19%	23%	-9%	16%	-25%	-44%	-1%	0%	-5%
Dry (16%)	2%	-9%	-9%	-16%	-4%	-15%	38%	-31%	-26%	-3%	0%	-1%
Critical (27%)	4%	-6%	-7%	-23%	-26%	-12%	45%	-28%	-10%	-9%	3%	4%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.3.4.4 Stanislaus River at Mouth, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	662	653	656	688	1,117	1,153	1,804	1,679	3,009	661	569	673
20%	582	548	522	557	694	613	1,608	1,592	2,016	555	485	508
30%	507	492	464	518	562	562	1,489	1,533	1,772	502	461	481
40%	471	459	427	473	512	522	1,040	1,423	1,092	444	445	457
50%	405	421	378	412	484	446	821	1,331	694	412	443	439
60%	377	388	341	364	423	394	637	1,049	572	386	416	431
70%	346	355	329	339	331	361	529	972	402	378	395	396
80%	327	312	311	318	296	295	440	865	352	350	373	373
90%	249	280	269	283	257	233	406	787	312	318	331	316
Long Term												
Full Simulation Period ^b	471	507	549	696	766	756	1,004	1,265	1,231	542	491	545
Water Year Types^c												
Wet (23%)	530	737	980	1,176	1,407	1,704	1,731	1,634	2,632	939	772	985
Above Normal (24%)	494	463	451	840	852	680	1,126	1,323	1,495	535	463	484
Below Normal (10%)	480	503	506	532	589	489	1,057	1,443	807	452	440	443
Dry (16%)	487	437	415	433	484	407	616	1,166	555	377	404	408
Critical (27%)	384	393	360	366	367	309	476	887	334	335	343	338

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,121	456	442	570	1,081	1,952	1,950	2,148	1,536	719	571	659
20%	1,029	382	378	416	586	1,708	1,815	1,974	1,319	564	488	501
30%	979	348	319	363	483	495	1,707	1,806	1,139	502	461	473
40%	903	336	304	347	401	415	1,630	1,672	1,034	442	445	443
50%	854	318	290	337	368	365	1,529	1,434	635	407	443	439
60%	818	292	281	326	319	333	1,311	1,290	485	382	413	428
70%	764	267	262	312	272	312	1,168	1,183	383	371	389	389
80%	748	260	241	295	245	241	1,044	962	343	339	367	356
90%	681	248	224	270	230	207	865	752	300	307	305	316
Long Term												
Full Simulation Period ^b	891	396	428	631	704	860	1,437	1,458	863	521	476	522
Water Year Types^c												
Wet (23%)	937	624	784	1,115	1,380	2,073	1,744	1,866	1,409	880	716	909
Above Normal (24%)	898	342	372	790	770	801	1,356	1,651	1,257	534	467	480
Below Normal (10%)	925	354	358	430	516	539	1,518	1,444	656	449	440	429
Dry (16%)	900	322	300	347	403	345	1,488	1,442	522	375	397	399
Critical (27%)	829	306	272	311	306	286	1,187	944	310	311	337	335

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	69%	-30%	-33%	-17%	-3%	69%	8%	28%	-49%	9%	0%	-2%
20%	77%	-30%	-28%	-25%	-16%	178%	13%	24%	-35%	2%	1%	-1%
30%	93%	-29%	-31%	-30%	-14%	-12%	15%	18%	-36%	0%	0%	-2%
40%	92%	-27%	-29%	-27%	-22%	-20%	57%	17%	-5%	0%	0%	-3%
50%	111%	-25%	-23%	-18%	-24%	-18%	86%	8%	-8%	-1%	0%	0%
60%	117%	-25%	-18%	-10%	-25%	-16%	106%	23%	-15%	-1%	-1%	-1%
70%	121%	-25%	-20%	-8%	-18%	-14%	121%	22%	-5%	-2%	-1%	-2%
80%	129%	-17%	-22%	-7%	-17%	-18%	137%	11%	-3%	-3%	-1%	-4%
90%	174%	-12%	-17%	-4%	-10%	-11%	113%	-4%	-4%	-3%	-8%	0%
Long Term												
Full Simulation Period ^b	89%	-22%	-22%	-9%	-8%	14%	43%	15%	-30%	-4%	-3%	-4%
Water Year Types^c												
Wet (23%)	77%	-15%	-20%	-5%	-2%	22%	1%	14%	-46%	-6%	-7%	-8%
Above Normal (24%)	82%	-26%	-17%	-6%	-10%	18%	20%	25%	-16%	0%	1%	-1%
Below Normal (10%)	93%	-29%	-29%	-19%	-12%	10%	44%	0%	-19%	-1%	0%	-3%
Dry (16%)	85%	-26%	-28%	-20%	-17%	-15%	142%	24%	-6%	0%	-2%	-2%
Critical (27%)	116%	-22%	-24%	-15%	-16%	-7%	149%	7%	-7%	-7%	-2%	-1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

5C.3.3.5 Stanislaus River below New Melones Temperature

Table 5C.3.3.5.1 Stanislaus River below New Melones Reservoir, Monthly Temperature

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	58.8	56.0	53.6	52.1	51.1	50.7	51.0	51.6	52.6	53.7	55.1	57.5
20%	55.6	54.6	52.7	51.5	50.4	49.9	50.2	51.1	51.8	52.5	53.0	54.4
30%	53.4	53.3	52.3	50.9	49.7	49.5	49.9	50.5	51.1	51.8	52.5	53.0
40%	52.9	52.8	51.8	50.6	49.4	49.2	49.7	50.3	50.8	51.4	51.9	52.5
50%	52.4	52.5	51.6	50.2	49.2	49.0	49.3	49.7	50.3	51.1	51.6	52.0
60%	52.0	52.1	51.4	49.9	48.9	48.7	48.9	49.3	49.7	50.4	50.9	51.4
70%	51.4	51.6	51.0	49.6	48.7	48.1	48.4	49.0	49.3	50.0	50.5	51.0
80%	51.1	51.2	50.3	49.2	48.0	47.5	48.0	48.4	48.9	49.6	50.1	50.7
90%	49.9	49.9	49.8	48.3	47.0	46.8	46.9	47.2	47.5	48.5	48.9	49.3
Long Term												
Full Simulation Period ^b	53.4	52.8	51.7	50.2	49.1	48.8	49.2	49.9	50.6	51.3	52.2	53.1
Water Year Types^c												
Wet (32%)	50.0	50.0	49.1	49.4	48.3	48.1	48.1	48.4	48.9	49.3	49.9	50.3
Above Normal (16%)	53.4	53.0	51.6	50.1	48.7	48.3	48.5	49.0	49.5	50.2	51.0	51.6
Below Normal (13%)	52.8	52.5	51.6	50.5	49.4	48.9	49.2	49.8	50.4	51.1	51.9	52.4
Dry (24%)	53.0	52.9	52.0	51.1	50.0	49.6	49.8	50.4	51.1	51.9	52.9	53.9
Critical (15%)	57.4	54.4	52.4	50.4	49.7	49.5	51.0	53.0	54.6	55.8	57.4	60.4

Alternative 1

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	58.1	55.8	53.6	52.1	51.4	50.7	51.0	51.6	52.5	53.6	55.2	56.5
20%	54.2	54.2	52.7	51.4	50.5	50.0	50.2	51.1	51.7	52.4	52.9	53.5
30%	53.1	53.1	52.3	51.0	49.9	49.5	49.9	50.5	51.0	51.7	52.4	52.9
40%	52.5	52.7	51.9	50.7	49.5	49.2	49.7	50.3	50.8	51.4	51.9	52.3
50%	52.1	52.3	51.5	50.3	49.3	49.1	49.3	49.7	50.3	51.0	51.5	51.9
60%	51.8	52.0	51.3	50.0	49.0	48.7	48.9	49.3	49.7	50.3	50.9	51.4
70%	51.2	51.5	51.0	49.6	48.7	48.2	48.5	48.9	49.4	50.0	50.5	50.9
80%	51.0	51.2	50.4	49.3	48.2	47.6	48.0	48.5	48.9	49.6	50.1	50.7
90%	49.6	49.9	49.8	48.5	47.0	46.9	47.0	47.2	47.6	48.4	48.7	49.3
Long Term												
Full Simulation Period ^b	53.0	52.7	51.7	50.3	49.2	48.8	49.2	49.9	50.4	51.3	52.1	52.7
Water Year Types^c												
Wet (32%)	49.7	49.8	49.1	49.5	48.4	48.0	48.2	48.5	48.9	49.4	49.9	50.3
Above Normal (16%)	53.1	52.7	51.5	50.1	48.8	48.4	48.6	49.0	49.5	50.2	51.0	51.5
Below Normal (13%)	52.2	52.1	51.5	50.6	49.5	48.9	49.2	49.7	50.3	51.0	51.7	52.2
Dry (24%)	52.7	52.6	51.9	51.1	50.0	49.6	49.8	50.4	51.1	51.8	52.7	53.5
Critical (15%)	57.3	55.4	52.8	50.7	49.9	49.8	50.8	53.2	53.2	56.4	57.2	58.3

Alternative 1 minus No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-0.7	-0.3	0.0	0.0	0.3	0.1	0.0	0.0	-0.1	-0.1	0.1	-0.9
20%	-1.4	-0.4	0.0	-0.1	0.1	0.1	0.0	0.0	0.0	-0.1	-0.1	-0.9
30%	-0.3	-0.1	0.0	0.0	0.1	0.1	0.1	0.0	0.0	-0.2	-0.1	-0.1
40%	-0.4	-0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.2
50%	-0.3	-0.2	0.0	0.1	0.1	0.0	0.0	0.0	0.0	-0.1	0.0	-0.2
60%	-0.2	-0.1	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70%	-0.2	-0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.1	0.0	0.0	-0.1
80%	-0.1	0.0	0.0	0.1	0.2	0.1	0.1	0.1	0.1	0.0	0.1	-0.1
90%	-0.3	0.0	0.0	0.2	0.0	0.0	0.0	0.0	0.1	0.0	-0.2	0.1
Long Term												
Full Simulation Period ^b	-0.3	-0.1	0.0	0.1	0.1	0.0	0.0	0.0	-0.2	0.1	-0.1	-0.4
Water Year Types^c												
Wet (32%)	-0.3	-0.2	0.0	0.1	0.1	-0.1	0.1	0.0	0.1	0.0	0.0	0.0
Above Normal (16%)	-0.4	-0.3	-0.1	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	-0.1
Below Normal (13%)	-0.6	-0.4	-0.1	0.1	0.1	0.1	0.0	0.0	-0.1	-0.1	-0.2	-0.3
Dry (24%)	-0.3	-0.3	-0.1	0.0	0.1	0.0	0.0	0.0	0.0	-0.1	-0.2	-0.3
Critical (15%)	-0.1	1.0	0.3	0.3	0.3	0.2	-0.3	0.2	-1.4	0.6	-0.1	-2.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.5.3 Stanislaus River below New Melones Reservoir, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	58.1	55.8	53.6	52.1	51.4	50.7	51.0	51.6	52.5	53.6	55.2	56.5
20%	54.2	54.2	52.7	51.4	50.5	50.0	50.2	51.1	51.7	52.4	52.9	53.5
30%	53.1	53.1	52.3	51.0	49.9	49.5	49.9	50.5	51.0	51.7	52.4	52.9
40%	52.5	52.7	51.9	50.7	49.5	49.2	49.7	50.3	50.8	51.4	51.9	52.3
50%	52.1	52.3	51.5	50.3	49.3	49.1	49.3	49.7	50.3	51.0	51.5	51.9
60%	51.8	52.0	51.3	50.0	49.0	48.7	48.9	49.3	49.7	50.3	50.9	51.4
70%	51.2	51.5	51.0	49.6	48.7	48.2	48.5	48.9	49.4	50.0	50.5	50.9
80%	51.0	51.2	50.4	49.3	48.2	47.6	48.0	48.5	48.9	49.6	50.1	50.7
90%	49.6	49.9	49.8	48.5	47.0	46.9	47.0	47.2	47.6	48.4	48.7	49.3
Long Term												
Full Simulation Period ^b	53.0	52.7	51.7	50.3	49.2	48.8	49.2	49.9	50.4	51.3	52.1	52.7
Water Year Types^c												
Wet (32%)	49.7	49.8	49.1	49.5	48.4	48.0	48.2	48.5	48.9	49.4	49.9	50.3
Above Normal (16%)	53.1	52.7	51.5	50.1	48.8	48.4	48.6	49.0	49.5	50.2	51.0	51.5
Below Normal (13%)	52.2	52.1	51.5	50.6	49.5	48.9	49.2	49.7	50.3	51.0	51.7	52.2
Dry (24%)	52.7	52.6	51.9	51.1	50.0	49.6	49.8	50.4	51.1	51.8	52.7	53.5
Critical (15%)	57.3	55.4	52.8	50.7	49.9	49.8	50.8	53.2	53.2	56.4	57.2	58.3

Alternative 3

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	55.7	55.3	53.2	52.3	51.1	50.8	51.1	51.6	52.2	53.0	53.7	54.9
20%	53.6	53.7	52.5	51.4	50.4	50.1	50.3	50.9	51.6	52.1	52.6	53.3
30%	52.6	52.7	52.1	51.0	49.9	49.6	50.0	50.4	50.9	51.5	52.0	52.5
40%	52.1	52.3	51.7	50.6	49.5	49.3	49.7	50.2	50.5	51.2	51.6	52.0
50%	51.7	51.9	51.4	50.3	49.5	49.2	49.3	49.6	50.0	50.6	51.1	51.5
60%	51.3	51.6	51.3	50.0	49.1	48.7	49.0	49.3	49.7	50.2	50.7	51.2
70%	51.1	51.3	51.0	49.7	48.8	48.5	48.7	49.1	49.5	49.9	50.4	50.8
80%	50.6	50.8	50.5	49.3	48.4	48.1	48.2	48.5	48.9	49.3	49.7	50.4
90%	49.7	49.9	50.0	48.4	47.3	47.1	47.3	47.6	48.0	48.5	48.9	49.4
Long Term												
Full Simulation Period ^b	52.5	52.4	51.6	50.3	49.3	49.0	49.3	49.7	50.3	51.1	51.6	52.1
Water Year Types^c												
Wet (32%)	49.4	49.5	49.0	49.4	48.5	48.2	48.3	48.6	48.9	49.3	49.8	50.2
Above Normal (16%)	52.4	52.2	51.3	50.1	48.9	48.5	48.8	49.1	49.5	50.1	50.6	51.1
Below Normal (13%)	51.5	51.5	51.2	50.4	49.5	49.0	49.3	49.7	50.2	50.8	51.4	51.8
Dry (24%)	52.3	52.4	51.8	50.9	50.0	49.6	49.9	50.3	50.9	51.5	52.1	52.7
Critical (15%)	55.8	55.1	52.9	51.2	50.4	50.1	50.8	51.8	53.5	55.6	56.3	56.7

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-2.5	-0.5	-0.4	0.1	-0.3	0.1	0.1	0.0	-0.3	-0.6	-1.5	-1.6
20%	-0.6	-0.4	-0.2	0.0	0.0	0.1	0.2	-0.1	-0.1	-0.3	-0.3	-0.2
30%	-0.5	-0.4	-0.2	0.0	0.0	0.1	0.0	-0.1	-0.2	-0.2	-0.4	-0.4
40%	-0.5	-0.4	-0.2	-0.1	0.0	0.1	0.0	-0.1	-0.3	-0.2	-0.3	-0.4
50%	-0.4	-0.3	-0.1	0.0	0.1	0.1	0.0	-0.1	-0.3	-0.5	-0.4	-0.4
60%	-0.4	-0.4	-0.1	0.0	0.0	0.1	0.1	0.0	0.0	-0.1	-0.2	-0.2
70%	-0.1	-0.2	0.0	0.1	0.1	0.3	0.3	0.1	0.0	-0.1	-0.1	-0.1
80%	-0.4	-0.4	0.2	0.0	0.2	0.4	0.2	0.0	0.1	-0.3	-0.4	-0.3
90%	0.1	0.0	0.2	-0.1	0.4	0.3	0.3	0.4	0.4	0.1	0.3	0.1
Long Term												
Full Simulation Period ^b	-0.6	-0.3	-0.1	0.0	0.1	0.1	0.1	-0.2	0.0	-0.3	-0.4	-0.6
Water Year Types^c												
Wet (32%)	-0.3	-0.2	-0.1	0.0	0.1	0.1	0.1	0.1	0.0	0.0	-0.1	-0.1
Above Normal (16%)	-0.6	-0.5	-0.2	0.0	0.1	0.2	0.2	0.1	0.0	-0.2	-0.3	-0.4
Below Normal (13%)	-0.7	-0.6	-0.3	-0.2	0.0	0.1	0.1	0.0	-0.1	-0.2	-0.3	-0.4
Dry (24%)	-0.3	-0.3	-0.1	-0.2	0.0	0.0	0.1	-0.1	-0.2	-0.4	-0.6	-0.9
Critical (15%)	-1.5	-0.3	0.2	0.5	0.5	0.3	0.0	-1.4	0.3	-0.7	-1.0	-1.5

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

5C.3.3.6 Stanislaus River below Tulloch Reservoir Temperature

Table 5C.3.3.6.1 Stanislaus River below Tulloch Reservoir, Monthly Temperature

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	60.5	59.0	54.8	50.7	50.2	51.2	52.6	53.6	54.7	56.5	57.4	59.2
20%	57.4	56.6	53.3	50.3	49.5	50.6	52.1	53.0	54.1	55.0	55.7	56.7
30%	55.6	55.1	52.8	49.6	48.8	50.2	51.7	52.6	53.4	54.3	55.0	55.6
40%	55.1	54.6	52.0	49.1	48.5	49.8	51.3	52.4	52.9	53.9	54.5	55.0
50%	54.5	54.1	51.7	48.7	48.0	49.6	51.0	52.1	52.6	53.7	54.1	54.5
60%	54.1	53.9	51.4	48.3	47.8	49.3	50.6	51.6	52.2	52.8	53.5	54.0
70%	53.6	53.2	50.9	47.8	47.5	48.9	50.1	51.3	51.8	52.4	53.2	53.5
80%	53.2	52.6	50.4	47.1	46.7	48.4	49.7	51.0	51.4	51.8	52.8	53.1
90%	52.0	51.8	49.9	46.3	45.8	47.5	48.8	50.2	50.3	50.8	51.5	51.8
Long Term												
Full Simulation Period ^b	55.6	54.7	51.9	48.6	48.1	49.5	50.9	52.1	52.8	53.7	54.6	55.4
Water Year Types^c												
Wet (32%)	51.9	51.5	49.1	47.6	47.5	49.0	49.9	51.1	51.3	51.8	52.5	52.8
Above Normal (16%)	55.8	54.8	51.9	48.5	47.9	49.3	50.6	51.4	52.0	52.7	53.5	54.0
Below Normal (13%)	54.9	54.2	51.5	48.7	47.9	49.6	51.2	52.0	52.5	53.6	54.3	54.9
Dry (24%)	55.2	54.7	52.1	48.9	48.3	49.8	51.5	52.4	53.3	54.4	55.3	56.1
Critical (15%)	60.0	57.4	53.8	50.0	49.2	50.5	52.3	54.3	56.3	58.2	59.3	61.8

Alternative 1

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	59.7	59.0	54.7	50.9	50.3	51.4	52.7	53.7	54.6	56.4	57.2	58.4
20%	56.6	56.3	53.3	50.3	49.7	50.8	51.9	53.2	54.0	55.0	55.6	56.3
30%	55.6	55.1	52.7	49.6	49.0	50.3	51.6	52.8	53.3	54.1	54.9	55.5
40%	55.0	54.5	52.1	49.2	48.7	49.8	51.3	52.4	53.0	53.8	54.5	54.9
50%	54.6	54.2	51.7	48.9	48.2	49.7	51.0	52.2	52.7	53.5	54.0	54.4
60%	54.0	53.9	51.5	48.4	47.9	49.5	50.7	51.8	52.4	52.6	53.4	53.9
70%	53.7	53.3	51.1	48.0	47.7	49.0	50.2	51.5	51.9	52.3	53.1	53.5
80%	53.3	52.8	50.5	47.4	47.2	48.5	49.7	50.9	51.5	51.6	52.7	53.1
90%	52.1	51.9	49.8	46.6	46.1	47.6	48.9	50.2	50.7	50.7	51.5	51.7
Long Term												
Full Simulation Period ^b	55.4	54.7	52.0	48.7	48.3	49.6	50.9	52.2	52.8	53.6	54.5	55.1
Water Year Types^c												
Wet (32%)	51.8	51.4	49.0	47.8	47.7	49.0	50.0	51.2	51.7	51.6	52.4	52.8
Above Normal (16%)	55.6	54.8	52.0	48.7	48.1	49.4	50.6	51.6	52.0	52.6	53.4	53.9
Below Normal (13%)	54.7	54.0	51.4	48.8	48.2	49.7	50.9	52.2	52.4	53.4	54.2	54.6
Dry (24%)	55.1	54.6	52.2	49.0	48.5	50.0	51.5	52.6	53.3	54.3	55.1	55.8
Critical (15%)	59.4	58.1	54.1	50.2	49.5	50.7	52.2	54.5	55.4	58.0	59.5	60.4

Alternative 1 minus No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-0.7	-0.1	0.0	0.2	0.1	0.2	0.0	0.1	-0.1	-0.1	-0.2	-0.7
20%	-0.8	-0.3	0.0	0.0	0.2	0.2	-0.2	0.2	-0.1	0.0	-0.1	-0.4
30%	0.0	0.0	-0.1	0.0	0.2	0.1	-0.1	0.2	-0.1	-0.2	-0.1	-0.1
40%	-0.1	-0.1	0.1	0.1	0.2	0.0	0.0	0.0	0.1	-0.1	0.0	-0.1
50%	0.1	0.1	0.1	0.2	0.2	0.1	0.0	0.1	0.1	-0.2	-0.1	-0.2
60%	-0.1	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	-0.1	-0.1	0.0
70%	0.0	0.0	0.2	0.2	0.1	0.1	0.2	0.2	0.1	-0.2	0.0	0.0
80%	0.2	0.2	0.1	0.3	0.5	0.1	0.1	-0.1	0.1	-0.2	0.0	0.0
90%	0.1	0.1	-0.1	0.3	0.3	0.1	0.1	0.0	0.5	0.0	0.0	-0.1
Long Term												
Full Simulation Period ^b	-0.2	0.1	0.1	0.1	0.2	0.1	0.0	0.1	0.0	-0.2	-0.1	-0.3
Water Year Types^c												
Wet (32%)	-0.1	-0.1	0.0	0.1	0.2	0.0	0.1	0.0	0.4	-0.2	0.0	0.0
Above Normal (16%)	-0.2	0.1	0.1	0.1	0.2	0.1	-0.1	0.2	0.0	-0.1	-0.1	-0.1
Below Normal (13%)	-0.2	-0.2	-0.1	0.1	0.2	0.1	-0.3	0.3	-0.1	-0.2	-0.2	-0.2
Dry (24%)	-0.2	0.0	0.1	0.2	0.2	0.1	0.0	0.1	-0.1	-0.1	-0.2	-0.3
Critical (15%)	-0.6	0.7	0.3	0.2	0.2	0.2	-0.1	0.2	-0.9	-0.2	0.2	-1.4

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on an 81-year simulation period.
 c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.6.2 Stanislaus River below Tulloch Reservoir, Monthly Temperature

Second Basis of Comparison		Monthly Temperature (DEG-F)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	59.7	59.0	54.7	50.9	50.3	51.4	52.7	53.7	54.6	56.4	57.2	58.4	
20%	56.6	56.3	53.3	50.3	49.7	50.8	51.9	53.2	54.0	55.0	55.6	56.3	
30%	55.6	55.1	52.7	49.6	49.0	50.3	51.6	52.8	53.3	54.1	54.9	55.5	
40%	55.0	54.5	52.1	49.2	48.7	49.8	51.3	52.4	53.0	53.8	54.5	54.9	
50%	54.6	54.2	51.7	48.9	48.2	49.7	51.0	52.2	52.7	53.5	54.0	54.4	
60%	54.0	53.9	51.5	48.4	47.9	49.5	50.7	51.8	52.4	52.6	53.4	53.9	
70%	53.7	53.3	51.1	48.0	47.7	49.0	50.2	51.5	51.9	52.3	53.1	53.5	
80%	53.3	52.8	50.5	47.4	47.2	48.5	49.7	50.9	51.5	51.6	52.7	53.1	
90%	52.1	51.9	49.8	46.6	46.1	47.6	48.9	50.2	50.7	50.7	51.5	51.7	
Long Term													
Full Simulation Period ^b	55.4	54.7	52.0	48.7	48.3	49.6	50.9	52.2	52.8	53.6	54.5	55.1	
Water Year Types^c													
Wet (32%)	51.8	51.4	49.0	47.8	47.7	49.0	50.0	51.2	51.7	51.6	52.4	52.8	
Above Normal (16%)	55.6	54.8	52.0	48.7	48.1	49.4	50.6	51.6	52.0	52.6	53.4	53.9	
Below Normal (13%)	54.7	54.0	51.4	48.8	48.2	49.7	50.9	52.2	52.4	53.4	54.2	54.6	
Dry (24%)	55.1	54.6	52.2	49.0	48.5	50.0	51.5	52.6	53.3	54.3	55.1	55.8	
Critical (15%)	59.4	58.1	54.1	50.2	49.5	50.7	52.2	54.5	55.4	58.0	59.5	60.4	

No Action Alternative		Monthly Temperature (DEG-F)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	60.5	59.0	54.8	50.7	50.2	51.2	52.6	53.6	54.7	56.5	57.4	59.2	
20%	57.4	56.6	53.3	50.3	49.5	50.6	52.1	53.0	54.1	55.0	55.7	56.7	
30%	55.6	55.1	52.8	49.6	48.8	50.2	51.7	52.6	53.4	54.3	55.0	55.6	
40%	55.1	54.6	52.0	49.1	48.5	49.8	51.3	52.4	52.9	53.9	54.5	55.0	
50%	54.5	54.1	51.7	48.7	48.0	49.6	51.0	52.1	52.6	53.7	54.1	54.5	
60%	54.1	53.9	51.4	48.3	47.8	49.3	50.6	51.6	52.2	52.8	53.5	54.0	
70%	53.6	53.2	50.9	47.8	47.5	48.9	50.1	51.3	51.8	52.4	53.2	53.5	
80%	53.2	52.6	50.4	47.1	46.7	48.4	49.7	51.0	51.4	51.8	52.8	53.1	
90%	52.0	51.8	49.9	46.3	45.8	47.5	48.8	50.2	50.3	50.8	51.5	51.8	
Long Term													
Full Simulation Period ^b	55.6	54.7	51.9	48.6	48.1	49.5	50.9	52.1	52.8	53.7	54.6	55.4	
Water Year Types^c													
Wet (32%)	51.9	51.5	49.1	47.6	47.5	49.0	49.9	51.1	51.3	51.8	52.5	52.8	
Above Normal (16%)	55.8	54.8	51.9	48.5	47.9	49.3	50.6	51.4	52.0	52.7	53.5	54.0	
Below Normal (13%)	54.9	54.2	51.5	48.7	47.9	49.6	51.2	52.0	52.5	53.6	54.3	54.9	
Dry (24%)	55.2	54.7	52.1	48.9	48.3	49.8	51.5	52.4	53.3	54.4	55.3	56.1	
Critical (15%)	60.0	57.4	53.8	50.0	49.2	50.5	52.3	54.3	56.3	58.2	59.3	61.8	

No Action Alternative minus Second Basis of Comparison		Monthly Temperature (DEG-F)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	0.7	0.1	0.0	-0.2	-0.1	-0.2	0.0	-0.1	0.1	0.1	0.2	0.7	
20%	0.8	0.3	0.0	0.0	-0.2	-0.2	0.2	-0.2	0.1	0.0	0.1	0.4	
30%	0.0	0.0	0.1	0.0	-0.2	-0.1	0.1	-0.2	0.1	0.2	0.1	0.1	
40%	0.1	0.1	-0.1	-0.1	-0.2	0.0	0.0	0.0	-0.1	0.1	0.0	0.1	
50%	-0.1	-0.1	-0.1	-0.2	-0.2	-0.1	0.0	-0.1	-0.1	0.2	0.1	0.2	
60%	0.1	0.0	-0.1	-0.1	-0.1	-0.1	-0.1	-0.1	-0.1	0.1	0.1	0.0	
70%	0.0	0.0	-0.2	-0.2	-0.1	-0.1	-0.2	-0.2	-0.1	0.2	0.0	0.0	
80%	-0.2	-0.2	-0.1	-0.3	-0.5	-0.1	-0.1	0.1	-0.1	0.2	0.0	0.0	
90%	-0.1	-0.1	0.1	-0.3	-0.3	-0.1	-0.1	0.0	-0.5	0.0	0.0	0.1	
Long Term													
Full Simulation Period ^b	0.2	-0.1	-0.1	-0.1	-0.2	-0.1	0.0	-0.1	0.0	0.2	0.1	0.3	
Water Year Types^c													
Wet (32%)	0.1	0.1	0.0	-0.1	-0.2	0.0	-0.1	0.0	-0.4	0.2	0.0	0.0	
Above Normal (16%)	0.2	-0.1	-0.1	-0.1	-0.2	-0.1	0.1	-0.2	0.0	0.1	0.1	0.1	
Below Normal (13%)	0.2	0.2	0.1	-0.1	-0.2	-0.1	0.3	-0.3	0.1	0.2	0.2	0.2	
Dry (24%)	0.2	0.0	-0.1	-0.2	-0.2	-0.1	0.0	-0.1	0.1	0.1	0.2	0.3	
Critical (15%)	0.6	-0.7	-0.3	-0.2	-0.2	-0.2	0.1	-0.2	0.9	0.2	-0.2	1.4	

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on an 81-year simulation period.
 c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

5C.3.3.7 Stanislaus River below Goodwin Dam Temperature

Table 5C.3.3.7.1 Stanislaus River below Goodwin Dam, Monthly Temperature

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	60.7	59.2	54.6	51.1	50.8	51.9	53.1	54.1	55.6	57.6	58.3	60.1
20%	58.0	56.6	53.3	50.3	50.2	51.4	52.4	53.6	54.8	55.9	56.5	57.4
30%	56.1	55.5	52.5	49.7	49.5	50.8	52.1	53.0	54.0	55.1	55.8	56.4
40%	55.5	54.8	51.9	49.3	48.9	50.6	51.7	52.8	53.7	54.6	55.3	55.7
50%	55.0	54.2	51.6	48.9	48.8	50.3	51.4	52.6	53.3	54.4	54.8	55.3
60%	54.5	54.0	51.3	48.4	48.4	50.0	51.0	52.1	52.8	53.5	54.2	54.6
70%	54.0	53.5	51.0	48.0	48.0	49.8	50.6	51.8	52.5	53.2	53.9	54.2
80%	53.5	52.9	50.4	47.3	47.4	49.0	50.1	51.5	52.0	52.6	53.3	53.8
90%	52.4	52.1	49.9	46.5	46.7	48.3	49.2	50.6	50.8	51.5	52.2	52.6
Long Term												
Full Simulation Period ^b	56.0	54.9	51.9	48.8	48.7	50.2	51.3	52.5	53.5	54.6	55.3	56.1
Water Year Types^c												
Wet (32%)	52.3	51.8	49.1	47.9	48.0	49.4	50.2	51.5	51.8	52.5	53.2	53.4
Above Normal (16%)	56.2	55.1	52.0	48.9	48.6	50.2	51.0	51.9	52.6	53.5	54.2	54.7
Below Normal (13%)	55.3	54.4	51.4	48.8	48.6	50.3	51.5	52.4	53.2	54.4	55.1	55.6
Dry (24%)	55.6	54.8	52.0	49.0	48.9	50.7	51.9	52.9	54.1	55.2	56.0	56.8
Critical (15%)	60.4	57.6	53.6	50.1	49.9	51.3	52.8	54.9	57.2	59.4	60.4	62.6

Alternative 1

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	60.3	59.1	54.5	51.1	50.8	51.9	53.1	54.2	55.5	57.4	58.2	59.2
20%	57.3	56.5	53.3	50.3	50.2	51.4	52.4	53.6	54.9	55.9	56.4	57.0
30%	56.4	55.4	52.7	49.7	49.5	50.9	52.0	53.2	53.9	55.0	55.7	56.2
40%	55.7	54.7	52.1	49.3	49.1	50.7	51.7	52.8	53.6	54.6	55.2	55.6
50%	55.2	54.4	51.7	49.0	48.8	50.3	51.4	52.6	53.3	54.2	54.7	55.1
60%	54.9	54.1	51.5	48.5	48.5	50.1	51.1	52.2	53.0	53.4	54.1	54.6
70%	54.5	53.5	51.1	48.2	48.1	49.8	50.7	51.9	52.5	53.0	53.8	54.1
80%	53.9	52.9	50.5	47.6	47.7	49.1	50.2	51.5	52.0	52.4	53.4	53.8
90%	52.7	52.2	49.9	46.9	46.8	48.4	49.4	50.6	51.2	51.2	52.2	52.3
Long Term												
Full Simulation Period ^b	56.0	54.9	51.9	48.9	48.8	50.3	51.3	52.7	53.4	54.4	55.3	55.8
Water Year Types^c												
Wet (32%)	52.4	51.6	49.1	48.0	48.1	49.5	50.3	51.6	52.1	52.3	53.1	53.4
Above Normal (16%)	56.3	55.1	52.1	49.0	48.8	50.3	51.0	52.0	52.6	53.4	54.1	54.6
Below Normal (13%)	55.3	54.2	51.3	48.9	48.7	50.4	51.4	52.6	53.1	54.2	54.9	55.4
Dry (24%)	55.7	54.8	52.1	49.1	49.1	50.7	52.0	53.0	54.0	55.1	55.9	56.5
Critical (15%)	60.0	58.3	54.0	50.3	50.1	51.5	52.7	55.0	56.4	59.0	60.5	61.3

Alternative 1 minus No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-0.5	-0.1	-0.1	0.0	0.0	0.0	0.0	0.1	-0.1	-0.2	-0.2	-0.9
20%	-0.7	-0.1	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.1	-0.1	-0.4
30%	0.3	-0.1	0.2	0.1	0.1	0.1	-0.1	0.2	-0.1	-0.2	-0.1	-0.2
40%	0.2	-0.1	0.1	0.0	0.2	0.1	0.0	0.1	0.0	-0.1	0.0	-0.1
50%	0.3	0.1	0.1	0.1	0.0	0.1	0.0	0.0	0.0	-0.2	-0.1	-0.1
60%	0.3	0.1	0.2	0.1	0.2	0.1	0.1	0.1	0.3	-0.1	-0.1	0.0
70%	0.5	0.0	0.1	0.2	0.1	0.1	0.1	0.1	0.0	-0.1	-0.1	-0.1
80%	0.3	0.0	0.1	0.3	0.3	0.1	0.1	0.0	0.0	-0.2	0.1	0.0
90%	0.3	0.1	0.0	0.4	0.1	0.0	0.1	0.0	0.3	-0.3	0.0	-0.3
Long Term												
Full Simulation Period ^b	0.0	0.0	0.1	0.1	0.1	0.1	0.0	0.1	-0.1	-0.2	-0.1	-0.3
Water Year Types^c												
Wet (32%)	0.1	-0.1	0.0	0.1	0.1	0.1	0.1	0.1	0.3	-0.2	0.0	0.0
Above Normal (16%)	0.1	0.0	0.1	0.1	0.1	0.1	0.0	0.2	0.0	-0.1	-0.1	-0.1
Below Normal (13%)	0.0	-0.2	0.0	0.1	0.1	0.1	-0.2	0.2	-0.1	-0.2	-0.2	-0.2
Dry (24%)	0.1	-0.1	0.1	0.1	0.1	0.1	0.1	0.1	-0.1	-0.1	-0.1	-0.3
Critical (15%)	-0.4	0.7	0.4	0.2	0.2	0.2	0.0	0.1	-0.8	-0.3	0.1	-1.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

5C.3.3.8 Stanislaus River at Orange Blossom Bridge Temperature

Table 5C.3.3.8.1 Stanislaus River at Orange Blossom Bridge, Monthly Temperature

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61.6	58.7	53.5	51.3	52.5	55.8	55.3	57.7	63.9	65.6	65.4	64.5
20%	59.3	56.9	52.6	50.8	51.7	55.1	54.8	56.8	62.5	64.6	64.2	63.3
30%	57.6	56.2	52.3	50.1	51.2	54.6	54.1	56.0	61.6	64.1	63.4	62.0
40%	56.8	55.1	51.5	49.6	50.7	54.0	53.6	55.3	60.7	63.7	62.9	61.7
50%	56.4	54.9	51.1	49.1	50.3	53.7	53.1	55.0	59.3	63.2	62.5	61.2
60%	55.9	54.6	50.7	48.8	50.1	53.2	52.7	54.4	56.6	62.6	62.2	60.7
70%	55.2	54.1	50.5	48.4	49.6	52.1	52.2	53.9	55.9	62.1	61.9	60.4
80%	54.9	53.7	50.2	47.9	49.2	51.0	51.9	53.6	55.3	61.5	61.5	59.9
90%	54.0	52.7	49.8	47.1	48.4	49.7	50.8	52.6	54.4	58.6	59.8	58.2
Long Term												
Full Simulation Period ^b	57.2	55.3	51.4	49.2	50.4	53.2	53.2	55.1	59.0	62.9	62.7	61.5
Water Year Types ^c												
Wet (32%)	53.6	52.3	49.0	48.6	49.5	50.8	51.5	53.3	55.2	60.0	60.0	58.5
Above Normal (16%)	57.5	55.7	51.7	49.7	50.7	53.6	52.8	54.6	58.0	62.5	62.2	60.9
Below Normal (13%)	56.5	54.7	50.9	49.1	50.4	53.9	53.4	54.8	59.5	63.4	62.8	61.5
Dry (24%)	56.9	55.2	51.3	49.2	50.7	54.5	54.1	56.0	61.4	64.0	63.5	62.4
Critical (15%)	61.4	57.7	52.6	50.1	51.7	54.9	55.5	58.2	63.7	67.5	67.5	66.9

Alternative 1

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62.7	58.9	53.4	51.2	52.1	55.3	56.2	56.9	63.5	65.3	65.3	64.1
20%	60.8	57.0	52.7	50.8	51.5	54.8	55.6	55.9	62.4	64.5	64.1	62.9
30%	60.1	55.7	52.4	50.0	50.9	54.3	55.3	55.5	61.6	64.0	63.3	61.9
40%	58.9	55.2	51.7	49.5	50.5	53.6	54.6	55.2	60.0	63.6	62.9	61.5
50%	58.3	54.7	51.3	49.1	50.2	53.1	53.9	54.8	58.4	63.0	62.5	61.0
60%	57.6	54.4	51.0	49.0	49.8	52.8	53.3	54.4	56.3	62.5	62.2	60.6
70%	57.0	54.1	50.7	48.4	49.5	52.2	52.6	54.0	55.4	61.9	61.8	60.1
80%	56.5	53.4	50.3	48.0	49.1	51.5	51.9	53.7	54.8	61.3	61.4	59.6
90%	55.7	52.7	49.9	47.4	48.5	50.5	51.0	52.8	53.5	60.1	60.3	58.2
Long Term												
Full Simulation Period ^b	58.8	55.2	51.5	49.2	50.3	53.1	53.9	54.9	58.5	62.8	62.7	61.2
Water Year Types ^c												
Wet (32%)	55.0	52.1	49.0	48.6	49.3	51.2	51.7	53.5	54.5	60.1	60.3	58.4
Above Normal (16%)	59.3	55.5	51.9	49.7	50.5	53.3	53.4	54.4	57.7	62.4	62.2	60.7
Below Normal (13%)	57.9	54.4	50.9	49.1	50.0	53.3	54.1	54.8	58.9	63.3	62.7	61.1
Dry (24%)	58.8	55.1	51.5	49.3	50.6	54.1	55.3	55.6	61.3	63.9	63.4	62.2
Critical (15%)	62.6	58.2	53.1	50.3	51.8	55.0	56.5	57.6	63.3	66.8	67.6	66.5

Alternative 1 minus No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1.1	0.2	-0.1	0.0	-0.4	-0.5	0.9	-0.8	-0.3	-0.2	-0.1	-0.4
20%	1.5	0.1	0.0	0.0	-0.1	-0.2	0.8	-0.9	-0.1	-0.1	-0.1	-0.4
30%	2.5	-0.5	0.1	-0.1	-0.3	-0.3	1.2	-0.4	-0.1	-0.1	-0.1	-0.1
40%	2.1	0.2	0.3	-0.1	-0.2	-0.4	1.0	-0.1	-0.7	-0.1	0.0	-0.2
50%	1.9	-0.2	0.2	0.0	-0.1	-0.6	0.8	-0.2	-0.9	-0.2	0.0	-0.2
60%	1.7	-0.1	0.3	0.2	-0.3	-0.4	0.6	0.0	-0.3	-0.1	0.0	-0.1
70%	1.7	0.0	0.2	0.0	-0.1	0.1	0.4	0.1	-0.5	-0.2	0.0	-0.3
80%	1.6	-0.2	0.1	0.1	-0.2	0.6	0.1	0.1	-0.5	-0.2	-0.1	-0.3
90%	1.7	0.0	0.1	0.3	0.1	0.8	0.2	0.2	-1.0	1.5	0.5	0.1
Long Term												
Full Simulation Period ^b	1.6	-0.1	0.2	0.0	-0.1	-0.1	0.7	-0.2	-0.4	-0.1	0.1	-0.2
Water Year Types ^c												
Wet (32%)	1.4	-0.2	0.0	0.0	-0.1	0.5	0.2	0.1	-0.7	0.2	0.3	-0.1
Above Normal (16%)	1.8	-0.2	0.2	0.0	-0.2	-0.3	0.6	-0.2	-0.3	-0.1	-0.1	-0.2
Below Normal (13%)	1.4	-0.3	0.1	0.0	-0.3	-0.6	0.8	0.0	-0.6	-0.2	-0.1	-0.3
Dry (24%)	1.9	-0.1	0.2	0.1	-0.1	-0.5	1.2	-0.5	-0.1	-0.1	-0.1	-0.2
Critical (15%)	1.2	0.5	0.4	0.2	0.1	0.1	1.0	-0.7	-0.4	-0.7	0.1	-0.4

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.8.2 Stanislaus River at Orange Blossom Bridge, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	62.7	58.9	53.4	51.2	52.1	55.3	56.2	56.9	63.5	65.3	65.3	64.1
20%	60.8	57.0	52.7	50.8	51.5	54.8	55.6	55.9	62.4	64.5	64.1	62.9
30%	60.1	55.7	52.4	50.0	50.9	54.3	55.3	55.5	61.6	64.0	63.3	61.9
40%	58.9	55.2	51.7	49.5	50.5	53.6	54.6	55.2	60.0	63.6	62.9	61.5
50%	58.3	54.7	51.3	49.1	50.2	53.1	53.9	54.8	58.4	63.0	62.5	61.0
60%	57.6	54.4	51.0	49.0	49.8	52.8	53.3	54.4	56.3	62.5	62.2	60.6
70%	57.0	54.1	50.7	48.4	49.5	52.2	52.6	54.0	55.4	61.9	61.8	60.1
80%	56.5	53.4	50.3	48.0	49.1	51.5	51.9	53.7	54.8	61.3	61.4	59.6
90%	55.7	52.7	49.9	47.4	48.5	50.5	51.0	52.8	53.5	60.1	60.3	58.2
Long Term												
Full Simulation Period ^b	58.8	55.2	51.5	49.2	50.3	53.1	53.9	54.9	58.5	62.8	62.7	61.2
Water Year Types^c												
Wet (32%)	55.0	52.1	49.0	48.6	49.3	51.2	51.7	53.5	54.5	60.1	60.3	58.4
Above Normal (16%)	59.3	55.5	51.9	49.7	50.5	53.3	53.4	54.4	57.7	62.4	62.2	60.7
Below Normal (13%)	57.9	54.4	50.9	49.1	50.0	53.3	54.1	54.8	58.9	63.3	62.7	61.1
Dry (24%)	58.8	55.1	51.5	49.3	50.6	54.1	55.3	55.6	61.3	63.9	63.4	62.2
Critical (15%)	62.6	58.2	53.1	50.3	51.8	55.0	56.5	57.6	63.3	66.8	67.6	66.5

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	61.6	58.7	53.5	51.3	52.5	55.8	55.3	57.7	63.9	65.6	65.4	64.5
20%	59.3	56.9	52.6	50.8	51.7	55.1	54.8	56.8	62.5	64.6	64.2	63.3
30%	57.6	56.2	52.3	50.1	51.2	54.6	54.1	56.0	61.6	64.1	63.4	62.0
40%	56.8	55.1	51.5	49.6	50.7	54.0	53.6	55.3	60.7	63.7	62.9	61.7
50%	56.4	54.9	51.1	49.1	50.3	53.7	53.1	55.0	59.3	63.2	62.5	61.2
60%	55.9	54.6	50.7	48.8	50.1	53.2	52.7	54.4	56.6	62.6	62.2	60.7
70%	55.2	54.1	50.5	48.4	49.6	52.1	52.2	53.9	55.9	62.1	61.9	60.4
80%	54.9	53.7	50.2	47.9	49.2	51.0	51.9	53.6	55.3	61.5	61.5	59.9
90%	54.0	52.7	49.8	47.1	48.4	49.7	50.8	52.6	54.4	58.6	59.8	58.2
Long Term												
Full Simulation Period ^b	57.2	55.3	51.4	49.2	50.4	53.2	53.2	55.1	59.0	62.9	62.7	61.5
Water Year Types^c												
Wet (32%)	53.6	52.3	49.0	48.6	49.5	50.8	51.5	53.3	55.2	60.0	60.0	58.5
Above Normal (16%)	57.5	55.7	51.7	49.7	50.7	53.6	52.8	54.6	58.0	62.5	62.2	60.9
Below Normal (13%)	56.5	54.7	50.9	49.1	50.4	53.9	53.4	54.8	59.5	63.4	62.8	61.5
Dry (24%)	56.9	55.2	51.3	49.2	50.7	54.5	54.1	56.0	61.4	64.0	63.5	62.4
Critical (15%)	61.4	57.7	52.6	50.1	51.7	54.9	55.5	58.2	63.7	67.5	67.5	66.9

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-1.1	-0.2	0.1	0.0	0.4	0.5	-0.9	0.8	0.3	0.2	0.1	0.4
20%	-1.5	-0.1	0.0	0.0	0.1	0.2	-0.8	0.9	0.1	0.1	0.1	0.4
30%	-2.5	0.5	-0.1	0.1	0.3	0.3	-1.2	0.4	0.1	0.1	0.1	0.1
40%	-2.1	-0.2	-0.3	0.1	0.2	0.4	-1.0	0.1	0.7	0.1	0.0	0.2
50%	-1.9	0.2	-0.2	0.0	0.1	0.6	-0.8	0.2	0.9	0.2	0.0	0.2
60%	-1.7	0.1	-0.3	-0.2	0.3	0.4	-0.6	0.0	0.3	0.1	0.0	0.1
70%	-1.7	0.0	-0.2	0.0	0.1	-0.1	-0.4	-0.1	0.5	0.2	0.0	0.3
80%	-1.6	0.2	-0.1	-0.1	0.2	-0.6	-0.1	-0.1	0.5	0.2	0.1	0.3
90%	-1.7	0.0	-0.1	-0.3	-0.1	-0.8	-0.2	-0.2	1.0	-1.5	-0.5	-0.1
Long Term												
Full Simulation Period ^b	-1.6	0.1	-0.2	0.0	0.1	0.1	-0.7	0.2	0.4	0.1	-0.1	0.2
Water Year Types^c												
Wet (32%)	-1.4	0.2	0.0	0.0	0.1	-0.5	-0.2	-0.1	0.7	-0.2	-0.3	0.1
Above Normal (16%)	-1.8	0.2	-0.2	0.0	0.2	0.3	-0.6	0.2	0.3	0.1	0.1	0.2
Below Normal (13%)	-1.4	0.3	-0.1	0.0	0.3	0.6	-0.8	0.0	0.6	0.2	0.1	0.3
Dry (24%)	-1.9	0.1	-0.2	-0.1	0.1	0.5	-1.2	0.5	0.1	0.1	0.1	0.2
Critical (15%)	-1.2	-0.5	-0.4	-0.2	-0.1	-0.1	-1.0	0.7	0.4	0.7	-0.1	0.4

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.8.3 Stanislaus River at Orange Blossom Bridge, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	62.7	58.9	53.4	51.2	52.1	55.3	56.2	56.9	63.5	65.3	65.3	64.1
20%	60.8	57.0	52.7	50.8	51.5	54.8	55.6	55.9	62.4	64.5	64.1	62.9
30%	60.1	55.7	52.4	50.0	50.9	54.3	55.3	55.5	61.6	64.0	63.3	61.9
40%	58.9	55.2	51.7	49.5	50.5	53.6	54.6	55.2	60.0	63.6	62.9	61.5
50%	58.3	54.7	51.3	49.1	50.2	53.1	53.9	54.8	58.4	63.0	62.5	61.0
60%	57.6	54.4	51.0	49.0	49.8	52.8	53.3	54.4	56.3	62.5	62.2	60.6
70%	57.0	54.1	50.7	48.4	49.5	52.2	52.6	54.0	55.4	61.9	61.8	60.1
80%	56.5	53.4	50.3	48.0	49.1	51.5	51.9	53.7	54.8	61.3	61.4	59.6
90%	55.7	52.7	49.9	47.4	48.5	50.5	51.0	52.8	53.5	60.1	60.3	58.2
Long Term												
Full Simulation Period ^b	58.8	55.2	51.5	49.2	50.3	53.1	53.9	54.9	58.5	62.8	62.7	61.2
Water Year Types^c												
Wet (32%)	55.0	52.1	49.0	48.6	49.3	51.2	51.7	53.5	54.5	60.1	60.3	58.4
Above Normal (16%)	59.3	55.5	51.9	49.7	50.5	53.3	53.4	54.4	57.7	62.4	62.2	60.7
Below Normal (13%)	57.9	54.4	50.9	49.1	50.0	53.3	54.1	54.8	58.9	63.3	62.7	61.1
Dry (24%)	58.8	55.1	51.5	49.3	50.6	54.1	55.3	55.6	61.3	63.9	63.4	62.2
Critical (15%)	62.6	58.2	53.1	50.3	51.8	55.0	56.5	57.6	63.3	66.8	67.6	66.5

Alternative 3

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	61.3	57.6	53.2	51.0	52.9	55.8	55.5	57.8	63.9	65.8	64.8	63.5
20%	60.0	56.6	52.7	50.7	51.9	55.2	54.8	56.7	63.2	64.8	63.8	62.6
30%	59.2	55.4	52.2	50.2	51.3	54.6	54.3	56.2	62.6	64.2	63.1	62.1
40%	58.3	54.8	51.6	49.5	50.9	54.1	53.8	55.6	62.1	63.9	62.8	61.4
50%	57.9	54.5	51.1	49.2	50.5	53.7	53.2	55.2	61.7	63.5	62.4	61.1
60%	57.4	54.1	50.9	48.8	50.1	53.4	52.8	54.7	61.3	63.3	62.1	60.8
70%	56.8	53.9	50.5	48.5	49.7	52.6	52.5	54.4	60.8	63.1	61.9	60.3
80%	56.4	53.5	50.2	48.2	49.4	51.6	51.8	53.8	60.3	62.7	61.6	60.0
90%	55.4	52.9	49.9	47.5	48.5	50.5	51.1	53.1	59.0	61.4	60.4	55.8
Long Term												
Full Simulation Period ^b	58.3	55.0	51.4	49.3	50.6	53.4	53.4	55.3	61.3	63.3	62.4	60.8
Water Year Types^c												
Wet (32%)	54.7	52.0	48.9	48.7	49.6	51.5	51.8	53.7	58.8	60.6	59.8	58.2
Above Normal (16%)	58.9	55.3	51.7	49.8	50.7	53.4	53.1	55.0	61.7	63.5	62.2	60.8
Below Normal (13%)	57.5	54.1	50.7	49.0	50.1	54.0	53.5	55.1	61.7	63.7	62.6	61.2
Dry (24%)	58.4	54.9	51.4	49.3	51.0	54.6	54.3	56.3	62.5	64.2	63.1	61.8
Critical (15%)	61.3	57.5	52.8	50.2	52.3	55.2	55.6	57.9	64.0	67.0	66.5	64.9

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-1.4	-1.4	-0.2	-0.3	0.8	0.5	-0.7	0.9	0.4	0.5	-0.5	-0.7
20%	-0.8	-0.5	0.0	-0.1	0.4	0.4	-0.8	0.8	0.7	0.3	-0.3	-0.3
30%	-0.9	-0.3	-0.2	0.2	0.4	0.3	-0.9	0.7	1.0	0.2	-0.2	0.2
40%	-0.7	-0.4	-0.1	0.0	0.4	0.5	-0.8	0.4	2.1	0.3	-0.1	-0.1
50%	-0.4	-0.2	-0.2	0.0	0.3	0.6	-0.6	0.4	3.3	0.5	-0.1	0.1
60%	-0.2	-0.3	-0.1	-0.1	0.3	0.6	-0.5	0.3	5.0	0.7	-0.1	0.2
70%	-0.1	-0.2	-0.2	0.1	0.2	0.4	-0.1	0.4	5.4	1.2	0.1	0.2
80%	-0.1	0.1	-0.1	0.2	0.3	0.1	-0.1	0.1	5.5	1.4	0.2	0.4
90%	-0.3	0.3	-0.1	0.1	0.0	0.0	0.1	0.3	5.5	1.3	0.1	-2.4
Long Term												
Full Simulation Period ^b	-0.5	-0.3	-0.1	0.1	0.3	0.4	-0.5	0.4	2.8	0.5	-0.4	-0.4
Water Year Types^c												
Wet (32%)	-0.3	-0.1	-0.1	0.1	0.3	0.3	0.0	0.2	4.3	0.4	-0.5	-0.3
Above Normal (16%)	-0.4	-0.3	-0.2	0.2	0.2	0.1	-0.4	0.5	4.0	1.1	0.0	0.1
Below Normal (13%)	-0.4	-0.3	-0.2	0.0	0.1	0.7	-0.6	0.4	2.9	0.4	-0.1	0.1
Dry (24%)	-0.4	-0.2	-0.1	0.0	0.4	0.5	-1.0	0.7	1.2	0.3	-0.3	-0.4
Critical (15%)	-1.2	-0.7	-0.3	-0.1	0.5	0.2	-0.9	0.3	0.7	0.2	-1.1	-1.6

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.8.4 Stanislaus River at Orange Blossom Bridge, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	62.7	58.9	53.4	51.2	52.1	55.3	56.2	56.9	63.5	65.3	65.3	64.1
20%	60.8	57.0	52.7	50.8	51.5	54.8	55.6	55.9	62.4	64.5	64.1	62.9
30%	60.1	55.7	52.4	50.0	50.9	54.3	55.3	55.5	61.6	64.0	63.3	61.9
40%	58.9	55.2	51.7	49.5	50.5	53.6	54.6	55.2	60.0	63.6	62.9	61.5
50%	58.3	54.7	51.3	49.1	50.2	53.1	53.9	54.8	58.4	63.0	62.5	61.0
60%	57.6	54.4	51.0	49.0	49.8	52.8	53.3	54.4	56.3	62.5	62.2	60.6
70%	57.0	54.1	50.7	48.4	49.5	52.2	52.6	54.0	55.4	61.9	61.8	60.1
80%	56.5	53.4	50.3	48.0	49.1	51.5	51.9	53.7	54.8	61.3	61.4	59.6
90%	55.7	52.7	49.9	47.4	48.5	50.5	51.0	52.8	53.5	60.1	60.3	58.2
Long Term												
Full Simulation Period ^b	58.8	55.2	51.5	49.2	50.3	53.1	53.9	54.9	58.5	62.8	62.7	61.2
Water Year Types^c												
Wet (32%)	55.0	52.1	49.0	48.6	49.3	51.2	51.7	53.5	54.5	60.1	60.3	58.4
Above Normal (16%)	59.3	55.5	51.9	49.7	50.5	53.3	53.4	54.4	57.7	62.4	62.2	60.7
Below Normal (13%)	57.9	54.4	50.9	49.1	50.0	53.3	54.1	54.8	58.9	63.3	62.7	61.1
Dry (24%)	58.8	55.1	51.5	49.3	50.6	54.1	55.3	55.6	61.3	63.9	63.4	62.2
Critical (15%)	62.6	58.2	53.1	50.3	51.8	55.0	56.5	57.6	63.3	66.8	67.6	66.5

Alternative 5

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	65.0	59.6	53.4	51.3	52.5	55.7	54.6	56.3	64.0	66.4	67.0	67.3
20%	60.0	58.0	52.6	50.6	51.7	55.0	54.1	55.8	62.7	65.1	65.0	64.2
30%	58.1	56.5	52.2	49.9	51.2	54.5	53.7	55.4	61.8	64.3	63.7	62.7
40%	57.1	55.3	51.6	49.6	50.7	54.0	53.5	55.0	61.0	63.7	63.0	61.8
50%	56.5	55.0	51.2	49.1	50.3	53.6	53.0	54.7	59.2	63.2	62.7	61.3
60%	55.9	54.6	50.8	48.9	50.1	53.3	52.6	54.3	57.0	62.7	62.3	60.9
70%	55.4	54.2	50.6	48.4	49.6	52.0	52.2	53.7	55.9	62.2	61.9	60.6
80%	55.0	53.7	50.3	47.9	49.2	51.0	51.8	53.4	55.3	61.6	61.5	60.0
90%	54.0	53.1	49.8	47.2	48.3	49.6	50.7	52.6	54.4	58.9	60.1	58.1
Long Term												
Full Simulation Period ^b	57.8	55.7	51.5	49.2	50.4	53.1	52.9	54.8	59.1	63.3	63.2	61.9
Water Year Types^c												
Wet (32%)	54.2	52.6	49.0	48.6	49.4	50.8	51.5	53.1	55.2	60.5	60.5	58.8
Above Normal (16%)	57.9	56.0	51.8	49.7	50.8	53.6	52.6	54.2	57.9	62.6	62.3	61.0
Below Normal (13%)	57.2	54.7	50.9	49.0	50.3	53.8	53.2	54.6	59.9	63.7	63.1	62.0
Dry (24%)	57.5	55.6	51.4	49.3	50.8	54.5	53.7	55.4	61.6	64.3	64.2	63.5
Critical (15%)	61.7	58.3	52.6	50.0	51.6	54.7	54.9	58.0	64.2	68.0	68.4	67.3

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2.3	0.7	0.0	0.1	0.4	0.4	-1.6	-0.6	0.5	1.1	1.7	3.1
20%	-0.8	0.9	0.0	-0.2	0.2	0.2	-1.5	-0.1	0.3	0.6	0.8	1.3
30%	-2.0	0.8	-0.2	0.0	0.3	0.3	-1.6	-0.1	0.2	0.3	0.4	0.8
40%	-1.8	0.1	-0.1	0.0	0.2	0.4	-1.1	-0.2	1.0	0.1	0.1	0.3
50%	-1.8	0.3	-0.1	-0.1	0.1	0.5	-0.8	-0.1	0.8	0.2	0.2	0.3
60%	-1.7	0.2	-0.2	-0.1	0.2	0.5	-0.6	0.0	0.7	0.2	0.1	0.3
70%	-1.5	0.2	-0.1	0.1	0.2	-0.2	-0.3	-0.4	0.5	0.3	0.1	0.4
80%	-1.5	0.3	0.0	-0.1	0.2	-0.6	-0.1	-0.3	0.6	0.3	0.1	0.3
90%	-1.7	0.4	-0.1	-0.2	-0.2	-0.9	-0.3	-0.2	0.9	-1.2	-0.3	-0.2
Long Term												
Full Simulation Period ^b	-1.0	0.4	-0.1	0.0	0.1	0.0	-0.9	-0.1	0.6	0.4	0.5	0.7
Water Year Types^c												
Wet (32%)	-0.8	0.5	0.1	0.0	0.1	-0.4	-0.2	-0.4	0.8	0.3	0.2	0.3
Above Normal (16%)	-1.4	0.5	0.0	0.1	0.2	0.3	-0.8	-0.2	0.2	0.2	0.2	0.4
Below Normal (13%)	-0.7	0.4	0.0	0.0	0.3	0.5	-0.9	-0.2	1.0	0.4	0.5	0.8
Dry (24%)	-1.3	0.5	0.0	0.0	0.2	0.4	-1.6	-0.1	0.2	0.4	0.8	1.3
Critical (15%)	-0.8	0.1	-0.5	-0.3	-0.2	-0.2	-1.5	0.5	0.9	1.1	0.8	0.8

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

5C.3.3.9 Stanislaus River at Mouth Temperature

Table 5C.3.3.9.1 Stanislaus River at Mouth, Monthly Temperature

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	64.3	58.6	51.9	51.4	55.1	60.5	62.1	65.5	72.3	76.5	75.2	71.8
20%	62.9	57.4	51.6	50.8	54.3	59.7	61.1	64.6	71.7	75.5	74.4	70.7
30%	61.7	56.8	51.0	50.2	53.8	59.1	60.3	63.6	70.8	74.9	73.8	70.4
40%	60.6	56.5	50.7	49.7	53.2	58.7	58.8	62.1	70.2	74.3	73.4	69.8
50%	60.1	55.7	50.3	49.4	52.9	57.9	57.9	61.0	67.8	73.8	73.0	69.5
60%	59.6	55.2	49.9	49.0	52.6	57.0	57.1	60.7	65.3	73.1	72.6	69.0
70%	59.0	55.0	49.7	48.8	52.1	55.7	56.2	59.8	63.8	72.9	72.4	68.6
80%	58.7	54.7	49.3	48.5	51.5	53.6	55.7	58.7	62.7	71.7	71.9	68.1
90%	58.2	54.2	49.0	47.9	50.6	52.1	54.8	58.0	61.7	69.3	70.7	66.9
Long Term												
Full Simulation Period ^b	60.8	56.0	50.4	49.6	52.9	57.1	58.3	61.6	67.3	73.1	72.6	69.0
Water Year Types^c												
Wet (32%)	57.1	53.3	48.5	49.4	51.8	53.6	55.5	58.8	62.9	70.1	70.2	66.6
Above Normal (16%)	61.2	56.5	51.0	50.5	53.4	57.9	57.9	61.6	66.7	73.1	72.9	69.0
Below Normal (13%)	60.1	55.2	49.8	49.2	52.8	58.0	58.5	61.0	68.6	74.3	73.1	69.5
Dry (24%)	60.7	55.8	50.1	49.2	53.2	58.9	59.8	63.3	70.3	74.7	73.4	70.0
Critical (15%)	63.9	57.8	50.7	49.9	54.3	59.7	62.0	65.5	71.4	76.1	75.3	72.0

Alternative 1

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	66.5	58.4	52.0	51.3	54.5	60.3	63.6	64.1	72.1	76.2	75.1	71.5
20%	65.2	57.8	51.6	50.8	54.0	59.5	63.0	63.5	71.5	75.3	74.3	70.6
30%	64.4	56.9	51.1	50.2	53.6	58.7	62.2	62.7	70.4	74.8	73.8	70.2
40%	63.9	56.3	50.9	49.7	53.0	58.2	60.8	61.5	69.6	74.2	73.4	69.7
50%	62.9	55.9	50.5	49.3	52.5	57.3	60.0	61.2	67.2	73.6	73.0	69.4
60%	62.3	55.3	50.1	49.1	52.2	56.6	58.2	60.8	65.1	73.0	72.6	68.8
70%	61.8	55.1	49.7	48.8	51.9	56.3	56.8	59.8	62.3	72.7	72.4	68.5
80%	61.2	54.6	49.5	48.4	51.4	55.5	56.1	59.1	61.0	71.5	72.0	68.2
90%	60.8	54.2	49.1	47.9	50.4	54.2	55.3	58.5	59.1	70.4	71.3	67.1
Long Term												
Full Simulation Period ^b	63.1	56.1	50.5	49.5	52.7	57.3	59.6	61.3	66.3	73.0	72.7	68.9
Water Year Types^c												
Wet (32%)	59.3	53.2	48.6	49.3	51.6	54.7	55.9	59.2	60.6	70.1	70.7	66.4
Above Normal (16%)	63.8	56.5	51.1	50.4	53.1	57.9	59.2	61.2	66.1	73.0	72.9	68.9
Below Normal (13%)	62.3	55.1	49.9	49.1	52.4	57.7	60.4	60.8	67.8	74.1	73.1	69.3
Dry (24%)	63.4	56.0	50.2	49.3	53.0	58.4	61.8	62.5	70.1	74.6	73.4	70.0
Critical (15%)	65.8	58.2	51.0	49.9	54.2	59.7	63.5	64.3	71.1	75.9	75.2	71.9

Alternative 1 minus No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2.2	-0.2	0.1	-0.1	-0.5	-0.2	1.6	-1.4	-0.2	-0.3	-0.1	-0.4
20%	2.3	0.3	0.1	0.0	-0.2	-0.2	1.9	-1.1	-0.2	-0.1	-0.1	-0.1
30%	2.6	0.1	0.1	0.0	-0.2	-0.4	1.9	-0.9	-0.3	-0.1	0.0	-0.2
40%	3.2	-0.2	0.1	0.0	-0.2	-0.5	2.0	-0.7	-0.6	-0.1	0.0	-0.2
50%	2.8	0.2	0.2	-0.1	-0.4	-0.6	2.1	0.2	-0.6	-0.2	0.0	-0.1
60%	2.6	0.1	0.2	0.0	-0.4	-0.3	1.1	0.1	-0.2	-0.1	0.0	-0.2
70%	2.7	0.1	0.0	0.0	-0.2	0.6	0.6	0.0	-1.5	-0.2	0.0	-0.2
80%	2.6	0.0	0.2	0.0	-0.1	1.9	0.4	0.4	-1.6	-0.2	0.1	0.0
90%	2.5	0.0	0.1	0.1	-0.2	2.1	0.5	0.5	-2.6	1.1	0.6	0.2
Long Term												
Full Simulation Period ^b	2.4	0.1	0.1	0.0	-0.2	0.2	1.3	-0.4	-1.0	-0.1	0.1	-0.1
Water Year Types^c												
Wet (32%)	2.2	-0.1	0.0	-0.1	-0.2	1.1	0.4	0.4	-2.4	0.0	0.5	-0.1
Above Normal (16%)	2.6	0.0	0.1	-0.1	-0.3	0.0	1.3	-0.5	-0.6	-0.1	0.0	-0.1
Below Normal (13%)	2.2	-0.2	0.1	-0.1	-0.4	-0.4	1.9	-0.2	-0.7	-0.2	0.0	-0.2
Dry (24%)	2.7	0.2	0.2	0.0	-0.3	-0.4	2.0	-0.8	-0.2	0.0	0.0	-0.1
Critical (15%)	1.8	0.4	0.3	0.1	0.0	0.0	1.5	-1.2	-0.3	-0.2	-0.1	-0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.9.2 Stanislaus River at Mouth, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	66.5	58.4	52.0	51.3	54.5	60.3	63.6	64.1	72.1	76.2	75.1	71.5
20%	65.2	57.8	51.6	50.8	54.0	59.5	63.0	63.5	71.5	75.3	74.3	70.6
30%	64.4	56.9	51.1	50.2	53.6	58.7	62.2	62.7	70.4	74.8	73.8	70.2
40%	63.9	56.3	50.9	49.7	53.0	58.2	60.8	61.5	69.6	74.2	73.4	69.7
50%	62.9	55.9	50.5	49.3	52.5	57.3	60.0	61.2	67.2	73.6	73.0	69.4
60%	62.3	55.3	50.1	49.1	52.2	56.6	58.2	60.8	65.1	73.0	72.6	68.8
70%	61.8	55.1	49.7	48.8	51.9	56.3	56.8	59.8	62.3	72.7	72.4	68.5
80%	61.2	54.6	49.5	48.4	51.4	55.5	56.1	59.1	61.0	71.5	72.0	68.2
90%	60.8	54.2	49.1	47.9	50.4	54.2	55.3	58.5	59.1	70.4	71.3	67.1
Long Term												
Full Simulation Period ^b	63.1	56.1	50.5	49.5	52.7	57.3	59.6	61.3	66.3	73.0	72.7	68.9
Water Year Types^c												
Wet (32%)	59.3	53.2	48.6	49.3	51.6	54.7	55.9	59.2	60.6	70.1	70.7	66.4
Above Normal (16%)	63.8	56.5	51.1	50.4	53.1	57.9	59.2	61.2	66.1	73.0	72.9	68.9
Below Normal (13%)	62.3	55.1	49.9	49.1	52.4	57.7	60.4	60.8	67.8	74.1	73.1	69.3
Dry (24%)	63.4	56.0	50.2	49.3	53.0	58.4	61.8	62.5	70.1	74.6	73.4	70.0
Critical (15%)	65.8	58.2	51.0	49.9	54.2	59.7	63.5	64.3	71.1	75.9	75.2	71.9

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	64.3	58.6	51.9	51.4	55.1	60.5	62.1	65.5	72.3	76.5	75.2	71.8
20%	62.9	57.4	51.6	50.8	54.3	59.7	61.1	64.6	71.7	75.5	74.4	70.7
30%	61.7	56.8	51.0	50.2	53.8	59.1	60.3	63.6	70.8	74.9	73.8	70.4
40%	60.6	56.5	50.7	49.7	53.2	58.7	58.8	62.1	70.2	74.3	73.4	69.8
50%	60.1	55.7	50.3	49.4	52.9	57.9	57.9	61.0	67.8	73.8	73.0	69.5
60%	59.6	55.2	49.9	49.0	52.6	57.0	57.1	60.7	65.3	73.1	72.6	69.0
70%	59.0	55.0	49.7	48.8	52.1	55.7	56.2	59.8	63.8	72.9	72.4	68.6
80%	58.7	54.7	49.3	48.5	51.5	53.6	55.7	58.7	62.7	71.7	71.9	68.1
90%	58.2	54.2	49.0	47.9	50.6	52.1	54.8	58.0	61.7	69.3	70.7	66.9
Long Term												
Full Simulation Period ^b	60.8	56.0	50.4	49.6	52.9	57.1	58.3	61.6	67.3	73.1	72.6	69.0
Water Year Types^c												
Wet (32%)	57.1	53.3	48.5	49.4	51.8	53.6	55.5	58.8	62.9	70.1	70.2	66.6
Above Normal (16%)	61.2	56.5	51.0	50.5	53.4	57.9	57.9	61.6	66.7	73.1	72.9	69.0
Below Normal (13%)	60.1	55.2	49.8	49.2	52.8	58.0	58.5	61.0	68.6	74.3	73.1	69.5
Dry (24%)	60.7	55.8	50.1	49.2	53.2	58.9	59.8	63.3	70.3	74.7	73.4	70.0
Critical (15%)	63.9	57.8	50.7	49.9	54.3	59.7	62.0	65.5	71.4	76.1	75.3	72.0

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-2.2	0.2	-0.1	0.1	0.5	0.2	-1.6	1.4	0.2	0.3	0.1	0.4
20%	-2.3	-0.3	-0.1	0.0	0.2	0.2	-1.9	1.1	0.2	0.1	0.1	0.1
30%	-2.6	-0.1	-0.1	0.0	0.2	0.4	-1.9	0.9	0.3	0.1	0.0	0.2
40%	-3.2	0.2	-0.1	0.0	0.2	0.5	-2.0	0.7	0.6	0.1	0.0	0.2
50%	-2.8	-0.2	-0.2	0.1	0.4	0.6	-2.1	-0.2	0.6	0.2	0.0	0.1
60%	-2.6	-0.1	-0.2	0.0	0.4	0.3	-1.1	-0.1	0.2	0.1	0.0	0.2
70%	-2.7	-0.1	0.0	0.0	0.2	-0.6	-0.6	0.0	1.5	0.2	0.0	0.2
80%	-2.6	0.0	-0.2	0.0	0.1	-1.9	-0.4	-0.4	1.6	0.2	-0.1	0.0
90%	-2.5	0.0	-0.1	-0.1	0.2	-2.1	-0.5	-0.5	2.6	-1.1	-0.6	-0.2
Long Term												
Full Simulation Period ^b	-2.4	-0.1	-0.1	0.0	0.2	-0.2	-1.3	0.4	1.0	0.1	-0.1	0.1
Water Year Types^c												
Wet (32%)	-2.2	0.1	0.0	0.1	0.2	-1.1	-0.4	-0.4	2.4	0.0	-0.5	0.1
Above Normal (16%)	-2.6	0.0	-0.1	0.1	0.3	0.0	-1.3	0.5	0.6	0.1	0.0	0.1
Below Normal (13%)	-2.2	0.2	-0.1	0.1	0.4	0.4	-1.9	0.2	0.7	0.2	0.0	0.2
Dry (24%)	-2.7	-0.2	-0.2	0.0	0.3	0.4	-2.0	0.8	0.2	0.0	0.0	0.1
Critical (15%)	-1.8	-0.4	-0.3	-0.1	0.0	0.0	-1.5	1.2	0.3	0.2	0.1	0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.9.3 Stanislaus River at Mouth, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	66.5	58.4	52.0	51.3	54.5	60.3	63.6	64.1	72.1	76.2	75.1	71.5
20%	65.2	57.8	51.6	50.8	54.0	59.5	63.0	63.5	71.5	75.3	74.3	70.6
30%	64.4	56.9	51.1	50.2	53.6	58.7	62.2	62.7	70.4	74.8	73.8	70.2
40%	63.9	56.3	50.9	49.7	53.0	58.2	60.8	61.5	69.6	74.2	73.4	69.7
50%	62.9	55.9	50.5	49.3	52.5	57.3	60.0	61.2	67.2	73.6	73.0	69.4
60%	62.3	55.3	50.1	49.1	52.2	56.6	58.2	60.8	65.1	73.0	72.6	68.8
70%	61.8	55.1	49.7	48.8	51.9	56.3	56.8	59.8	62.3	72.7	72.4	68.5
80%	61.2	54.6	49.5	48.4	51.4	55.5	56.1	59.1	61.0	71.5	72.0	68.2
90%	60.8	54.2	49.1	47.9	50.4	54.2	55.3	58.5	59.1	70.4	71.3	67.1
Long Term												
Full Simulation Period ^b	63.1	56.1	50.5	49.5	52.7	57.3	59.6	61.3	66.3	73.0	72.7	68.9
Water Year Types^c												
Wet (32%)	59.3	53.2	48.6	49.3	51.6	54.7	55.9	59.2	60.6	70.1	70.7	66.4
Above Normal (16%)	63.8	56.5	51.1	50.4	53.1	57.9	59.2	61.2	66.1	73.0	72.9	68.9
Below Normal (13%)	62.3	55.1	49.9	49.1	52.4	57.7	60.4	60.8	67.8	74.1	73.1	69.3
Dry (24%)	63.4	56.0	50.2	49.3	53.0	58.4	61.8	62.5	70.1	74.6	73.4	70.0
Critical (15%)	65.8	58.2	51.0	49.9	54.2	59.7	63.5	64.3	71.1	75.9	75.2	71.9

Alternative 3

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	65.7	58.3	51.9	51.6	55.2	60.9	62.6	65.8	73.2	76.9	75.3	71.7
20%	65.2	57.7	51.5	50.7	54.7	59.7	61.6	64.6	72.4	76.0	74.3	70.7
30%	64.0	56.7	51.0	50.2	53.8	59.2	60.4	63.7	72.1	75.5	73.8	70.2
40%	63.2	56.3	50.8	49.7	53.2	58.7	59.7	62.9	71.7	75.0	73.4	69.9
50%	62.9	55.6	50.4	49.4	52.8	58.2	58.3	62.5	71.1	74.7	73.1	69.4
60%	62.4	55.3	50.0	49.0	52.3	57.3	57.3	61.7	70.3	74.2	72.5	69.0
70%	61.7	55.0	49.6	48.8	52.0	56.7	56.6	60.9	69.3	73.8	72.4	68.7
80%	61.3	54.8	49.4	48.6	51.1	55.0	56.1	60.2	68.5	73.5	72.0	68.1
90%	60.6	54.3	49.0	47.9	50.3	53.5	55.4	59.0	67.4	73.0	71.3	62.2
Long Term												
Full Simulation Period ^b	62.9	56.0	50.4	49.6	52.8	57.5	58.7	62.5	69.9	73.7	72.4	68.6
Water Year Types^c												
Wet (32%)	59.1	53.3	48.6	49.4	51.4	54.9	55.8	60.0	66.7	70.5	69.7	65.8
Above Normal (16%)	63.8	56.5	51.0	50.5	53.1	57.7	58.3	62.4	70.9	74.8	73.1	69.1
Below Normal (13%)	62.2	55.1	49.7	49.1	52.4	58.3	59.2	62.0	70.7	74.8	73.1	69.5
Dry (24%)	63.2	55.9	50.2	49.2	53.5	59.0	60.2	63.9	71.6	75.0	73.4	69.9
Critical (15%)	65.2	57.8	50.8	49.8	54.7	60.0	62.3	65.7	72.3	76.4	75.1	71.4

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-0.8	-0.1	0.0	0.3	0.7	0.5	-1.0	1.7	1.1	0.7	0.2	0.3
20%	-0.1	-0.1	-0.1	0.0	0.6	0.2	-1.5	1.1	0.9	0.6	0.0	0.1
30%	-0.3	-0.2	-0.1	0.0	0.3	0.5	-1.7	1.0	1.6	0.7	0.0	0.0
40%	-0.6	0.0	0.0	0.0	0.2	0.5	-1.1	1.5	2.1	0.8	0.0	0.3
50%	0.0	-0.2	-0.1	0.1	0.3	0.9	-1.7	1.3	3.9	1.1	0.1	0.0
60%	0.1	0.0	-0.1	-0.1	0.1	0.7	-1.0	0.9	5.2	1.2	-0.1	0.2
70%	0.0	-0.1	-0.1	0.0	0.0	0.4	-0.2	1.1	7.0	1.1	0.0	0.2
80%	0.1	0.1	-0.1	0.1	-0.4	-0.4	0.0	1.1	7.5	2.0	0.0	-0.1
90%	-0.2	0.1	-0.1	0.0	-0.1	-0.6	0.1	0.6	8.3	2.6	0.1	-4.8
Long Term												
Full Simulation Period ^b	-0.2	-0.1	-0.1	0.0	0.1	0.3	-0.9	1.2	3.6	0.7	-0.3	-0.2
Water Year Types^c												
Wet (32%)	-0.2	0.0	0.0	0.1	-0.1	0.2	-0.1	0.8	6.1	0.4	-1.1	-0.6
Above Normal (16%)	0.0	0.0	-0.1	0.1	0.0	-0.1	-0.9	1.2	4.9	1.8	0.2	0.2
Below Normal (13%)	-0.2	0.0	-0.2	0.0	0.0	0.6	-1.2	1.2	2.8	0.7	0.0	0.2
Dry (24%)	-0.2	0.0	0.0	0.0	0.5	0.5	-1.6	1.4	1.5	0.4	0.0	-0.1
Critical (15%)	-0.6	-0.4	-0.2	-0.1	0.5	0.3	-1.2	1.4	1.2	0.5	-0.1	-0.5

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.9.4 Stanislaus River at Mouth, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	66.5	58.4	52.0	51.3	54.5	60.3	63.6	64.1	72.1	76.2	75.1	71.5
20%	65.2	57.8	51.6	50.8	54.0	59.5	63.0	63.5	71.5	75.3	74.3	70.6
30%	64.4	56.9	51.1	50.2	53.6	58.7	62.2	62.7	70.4	74.8	73.8	70.2
40%	63.9	56.3	50.9	49.7	53.0	58.2	60.8	61.5	69.6	74.2	73.4	69.7
50%	62.9	55.9	50.5	49.3	52.5	57.3	60.0	61.2	67.2	73.6	73.0	69.4
60%	62.3	55.3	50.1	49.1	52.2	56.6	58.2	60.8	65.1	73.0	72.6	68.8
70%	61.8	55.1	49.7	48.8	51.9	56.3	56.8	59.8	62.3	72.7	72.4	68.5
80%	61.2	54.6	49.5	48.4	51.4	55.5	56.1	59.1	61.0	71.5	72.0	68.2
90%	60.8	54.2	49.1	47.9	50.4	54.2	55.3	58.5	59.1	70.4	71.3	67.1
Long Term												
Full Simulation Period ^b	63.1	56.1	50.5	49.5	52.7	57.3	59.6	61.3	66.3	73.0	72.7	68.9
Water Year Types^c												
Wet (32%)	59.3	53.2	48.6	49.3	51.6	54.7	55.9	59.2	60.6	70.1	70.7	66.4
Above Normal (16%)	63.8	56.5	51.1	50.4	53.1	57.9	59.2	61.2	66.1	73.0	72.9	68.9
Below Normal (13%)	62.3	55.1	49.9	49.1	52.4	57.7	60.4	60.8	67.8	74.1	73.1	69.3
Dry (24%)	63.4	56.0	50.2	49.3	53.0	58.4	61.8	62.5	70.1	74.6	73.4	70.0
Critical (15%)	65.8	58.2	51.0	49.9	54.2	59.7	63.5	64.3	71.1	75.9	75.2	71.9

Alternative 5

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	65.4	58.6	52.2	51.4	55.1	60.5	60.1	64.4	72.3	76.3	75.4	72.0
20%	63.3	57.7	51.5	50.8	54.4	59.7	59.1	62.6	71.8	75.6	74.6	71.0
30%	62.0	57.0	51.0	50.3	53.7	59.2	58.7	61.5	70.9	75.0	73.9	70.5
40%	61.1	56.7	50.5	49.7	53.2	58.7	58.3	60.8	70.1	74.3	73.5	70.0
50%	60.4	56.0	50.3	49.3	52.9	57.9	57.7	60.1	67.6	73.9	73.1	69.7
60%	59.7	55.4	50.0	49.0	52.6	57.1	57.3	59.5	65.2	73.1	72.6	69.2
70%	59.2	55.1	49.7	48.9	52.0	55.9	56.3	59.0	64.0	72.9	72.4	68.7
80%	58.7	54.8	49.3	48.5	51.5	53.8	55.7	58.3	62.7	72.0	72.0	68.2
90%	58.2	54.2	48.9	47.9	50.6	52.1	55.0	57.9	61.5	69.4	71.3	66.9
Long Term												
Full Simulation Period ^b	61.1	56.2	50.4	49.6	52.9	57.1	57.6	60.6	67.4	73.4	72.9	69.2
Water Year Types^c												
Wet (32%)	57.5	53.4	48.6	49.4	51.8	53.8	55.6	58.4	63.1	70.8	71.0	66.8
Above Normal (16%)	61.5	56.7	51.1	50.5	53.5	57.9	57.5	60.4	66.5	73.1	73.0	69.1
Below Normal (13%)	60.6	55.3	49.8	49.2	52.8	58.0	58.1	60.2	68.7	74.4	73.2	69.7
Dry (24%)	61.0	56.1	50.1	49.3	53.3	58.9	58.7	62.0	70.2	74.7	73.6	70.4
Critical (15%)	64.1	58.1	50.7	49.8	54.3	59.7	60.0	64.0	71.6	76.4	75.6	72.2

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-1.1	0.3	0.2	0.1	0.6	0.2	-3.5	0.3	0.3	0.1	0.3	0.6
20%	-1.9	0.0	-0.1	0.0	0.3	0.2	-3.9	-0.9	0.4	0.2	0.3	0.4
30%	-2.3	0.1	-0.1	0.1	0.1	0.5	-3.4	-1.1	0.4	0.3	0.1	0.2
40%	-2.8	0.4	-0.4	0.0	0.2	0.5	-2.5	-0.7	0.5	0.1	0.1	0.3
50%	-2.5	0.1	-0.1	0.0	0.4	0.6	-2.3	-1.1	0.4	0.3	0.1	0.3
60%	-2.5	0.1	-0.1	0.0	0.4	0.5	-0.9	-1.3	0.0	0.1	0.0	0.4
70%	-2.6	0.0	0.0	0.1	0.1	-0.4	-0.5	-0.8	1.7	0.2	0.0	0.3
80%	-2.5	0.2	-0.2	0.1	0.1	-1.7	-0.4	-0.8	1.7	0.5	0.0	0.0
90%	-2.5	0.0	-0.2	0.0	0.2	-2.1	-0.3	-0.6	2.4	-1.0	0.0	-0.2
Long Term												
Full Simulation Period ^b	-2.0	0.1	-0.1	0.0	0.3	-0.1	-1.9	-0.6	1.1	0.4	0.2	0.3
Water Year Types^c												
Wet (32%)	-1.8	0.2	0.0	0.1	0.2	-0.9	-0.3	-0.8	2.5	0.7	0.3	0.4
Above Normal (16%)	-2.3	0.1	-0.1	0.1	0.3	0.0	-1.6	-0.8	0.5	0.1	0.0	0.2
Below Normal (13%)	-1.8	0.2	-0.1	0.1	0.4	0.4	-2.3	-0.6	0.9	0.3	0.1	0.3
Dry (24%)	-2.4	0.1	-0.1	0.0	0.4	0.5	-3.1	-0.5	0.1	0.1	0.2	0.4
Critical (15%)	-1.6	0.0	-0.3	-0.1	0.0	0.0	-3.5	-0.3	0.4	0.5	0.4	0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

5C.3.3.10 San Joaquin River at Vernalis Flow

Table 5C.3.3.10.1 San Joaquin River at Vernalis, Monthly Flow

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,498	2,953	4,804	11,135	14,596	15,471	14,974	14,174	9,351	5,890	2,796	3,060
20%	3,161	2,777	2,857	4,812	10,143	10,197	10,637	8,318	4,690	2,628	2,589	2,654
30%	2,980	2,527	2,401	3,610	6,118	8,459	8,616	5,534	3,364	1,985	1,904	2,490
40%	2,796	2,395	2,215	2,629	4,232	5,570	7,564	4,609	2,947	1,735	1,666	2,125
50%	2,601	2,219	2,101	2,402	3,420	3,847	6,017	3,925	2,246	1,487	1,488	1,930
60%	2,401	2,169	2,046	2,293	2,683	3,459	4,832	3,062	1,859	1,366	1,403	1,835
70%	2,247	2,059	1,979	2,114	2,305	2,906	3,776	2,699	1,448	1,154	1,307	1,739
80%	1,994	1,951	1,829	1,884	2,150	2,371	2,789	2,153	1,293	1,087	1,202	1,611
90%	1,849	1,763	1,669	1,699	1,947	2,204	1,887	1,678	1,085	885	1,067	1,476
Long Term												
Full Simulation Period ^b	2,672	2,611	3,391	5,070	6,655	7,278	7,528	6,039	4,194	2,622	1,847	2,223
Water Year Types^c												
Wet (23%)	2,918	3,513	6,545	11,446	15,776	16,863	15,423	14,628	11,335	6,676	3,135	3,416
Above Normal (24%)	2,700	2,416	2,663	4,883	6,881	7,536	8,542	5,264	3,280	1,989	1,975	2,345
Below Normal (10%)	2,538	2,249	3,661	3,507	3,651	4,149	6,337	4,140	2,076	1,463	1,446	1,837
Dry (16%)	2,767	2,569	2,232	2,402	2,549	3,241	3,996	2,805	1,680	1,254	1,347	1,776
Critical (27%)	2,426	2,168	1,915	1,877	2,090	2,288	2,307	1,929	1,115	926	1,060	1,487

Alternative 1

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,015	3,156	4,932	11,157	14,594	15,467	14,666	14,360	10,139	5,612	2,740	3,146
20%	2,692	2,843	2,953	4,819	10,200	9,482	10,169	8,291	5,696	2,636	2,600	2,658
30%	2,520	2,663	2,541	3,655	6,300	7,933	8,421	5,676	3,488	1,990	1,897	2,503
40%	2,331	2,500	2,341	2,692	4,268	5,393	7,435	4,617	3,188	1,742	1,676	2,142
50%	2,157	2,386	2,257	2,544	3,420	3,883	6,016	4,043	2,349	1,506	1,500	1,944
60%	1,952	2,244	2,165	2,343	2,774	3,511	4,349	3,276	1,895	1,379	1,415	1,842
70%	1,752	2,141	2,027	2,153	2,443	2,963	3,119	2,891	1,485	1,170	1,321	1,743
80%	1,597	1,984	1,903	1,923	2,174	2,414	2,442	2,362	1,274	1,088	1,211	1,611
90%	1,411	1,793	1,699	1,733	1,945	2,230	1,779	1,890	1,085	941	1,071	1,478
Long Term												
Full Simulation Period ^b	2,241	2,721	3,492	5,136	6,700	7,131	7,255	6,101	4,547	2,625	1,838	2,238
Water Year Types^c												
Wet (23%)	2,497	3,627	6,644	11,506	15,763	16,308	15,374	14,433	12,512	6,641	3,078	3,456
Above Normal (24%)	2,288	2,532	2,757	4,947	6,946	7,415	8,260	5,348	3,525	1,999	1,977	2,352
Below Normal (10%)	2,086	2,397	3,810	3,608	3,723	4,101	5,842	4,213	2,225	1,481	1,457	1,856
Dry (16%)	2,339	2,684	2,347	2,487	2,628	3,304	3,551	2,976	1,714	1,267	1,362	1,789
Critical (27%)	1,974	2,251	1,998	1,927	2,138	2,311	2,031	2,122	1,116	943	1,059	1,485

Alternative 1 minus No Action Alternative

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-14%	7%	3%	0%	0%	0%	-2%	1%	8%	-5%	-2%	3%
20%	-15%	2%	3%	0%	1%	-7%	-4%	0%	21%	0%	0%	0%
30%	-15%	5%	6%	1%	3%	-6%	-2%	3%	4%	0%	0%	1%
40%	-17%	4%	6%	2%	1%	-3%	-2%	0%	8%	0%	1%	1%
50%	-17%	7%	7%	6%	0%	1%	0%	3%	5%	1%	1%	1%
60%	-19%	3%	6%	2%	3%	2%	-10%	7%	2%	1%	1%	0%
70%	-22%	4%	2%	2%	6%	2%	-17%	7%	3%	1%	1%	0%
80%	-20%	2%	4%	2%	1%	2%	-12%	10%	-1%	0%	1%	0%
90%	-24%	2%	2%	2%	0%	1%	-6%	13%	0%	6%	0%	0%
Long Term												
Full Simulation Period ^b	-16%	4%	3%	1%	1%	-2%	-4%	1%	8%	0%	-1%	1%
Water Year Types^c												
Wet (23%)	-14%	3%	2%	1%	0%	-3%	0%	-1%	10%	-1%	-2%	1%
Above Normal (24%)	-15%	5%	4%	1%	1%	-2%	-3%	2%	7%	0%	0%	0%
Below Normal (10%)	-18%	7%	4%	3%	2%	-1%	-8%	2%	7%	1%	1%	1%
Dry (16%)	-15%	4%	5%	4%	3%	2%	-11%	6%	2%	1%	1%	1%
Critical (27%)	-19%	4%	4%	3%	2%	1%	-12%	10%	0%	2%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.3.10.2 San Joaquin River at Vernalis, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,015	3,156	4,932	11,157	14,594	15,467	14,666	14,360	10,139	5,612	2,740	3,146
20%	2,692	2,843	2,953	4,819	10,200	9,482	10,169	8,291	5,696	2,636	2,600	2,658
30%	2,520	2,663	2,541	3,655	6,300	7,933	8,421	5,676	3,488	1,990	1,897	2,503
40%	2,331	2,500	2,341	2,692	4,268	5,393	7,435	4,617	3,188	1,742	1,676	2,142
50%	2,157	2,386	2,257	2,544	3,420	3,883	6,016	4,043	2,349	1,506	1,500	1,944
60%	1,952	2,244	2,165	2,343	2,774	3,511	4,349	3,276	1,895	1,379	1,415	1,842
70%	1,752	2,141	2,027	2,153	2,443	2,963	3,119	2,891	1,485	1,170	1,321	1,743
80%	1,597	1,984	1,903	1,923	2,174	2,414	2,442	2,362	1,274	1,088	1,211	1,611
90%	1,411	1,793	1,699	1,733	1,945	2,230	1,779	1,890	1,085	941	1,071	1,478
Long Term												
Full Simulation Period ^b	2,241	2,721	3,492	5,136	6,700	7,131	7,255	6,101	4,547	2,625	1,838	2,238
Water Year Types^c												
Wet (23%)	2,497	3,627	6,644	11,506	15,763	16,308	15,374	14,433	12,512	6,641	3,078	3,456
Above Normal (24%)	2,288	2,532	2,757	4,947	6,946	7,415	8,260	5,348	3,525	1,999	1,977	2,352
Below Normal (10%)	2,086	2,397	3,810	3,608	3,723	4,101	5,842	4,213	2,225	1,481	1,457	1,856
Dry (16%)	2,339	2,684	2,347	2,487	2,628	3,304	3,551	2,976	1,714	1,267	1,362	1,789
Critical (27%)	1,974	2,251	1,998	1,927	2,138	2,311	2,031	2,122	1,116	943	1,059	1,485

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,498	2,953	4,804	11,135	14,596	15,471	14,974	14,174	9,351	5,890	2,796	3,060
20%	3,161	2,777	2,857	4,812	10,143	10,197	10,637	8,318	4,690	2,628	2,589	2,654
30%	2,980	2,527	2,401	3,610	6,118	8,459	8,616	5,534	3,364	1,985	1,904	2,490
40%	2,796	2,395	2,215	2,629	4,232	5,570	7,564	4,609	2,947	1,735	1,666	2,125
50%	2,601	2,219	2,101	2,402	3,420	3,847	6,017	3,925	2,246	1,487	1,488	1,930
60%	2,401	2,169	2,046	2,293	2,683	3,459	4,832	3,062	1,859	1,366	1,403	1,835
70%	2,247	2,059	1,979	2,114	2,305	2,906	3,776	2,699	1,448	1,154	1,307	1,739
80%	1,994	1,951	1,829	1,884	2,150	2,371	2,789	2,153	1,293	1,087	1,202	1,611
90%	1,849	1,763	1,669	1,699	1,947	2,204	1,887	1,678	1,085	885	1,067	1,476
Long Term												
Full Simulation Period ^b	2,672	2,611	3,391	5,070	6,655	7,278	7,528	6,039	4,194	2,622	1,847	2,223
Water Year Types^c												
Wet (23%)	2,918	3,513	6,545	11,446	15,776	16,863	15,423	14,628	11,335	6,676	3,135	3,416
Above Normal (24%)	2,700	2,416	2,663	4,883	6,881	7,536	8,542	5,264	3,280	1,989	1,975	2,345
Below Normal (10%)	2,538	2,249	3,661	3,507	3,651	4,149	6,337	4,140	2,076	1,463	1,446	1,837
Dry (16%)	2,767	2,569	2,232	2,402	2,549	3,241	3,996	2,805	1,680	1,254	1,347	1,776
Critical (27%)	2,426	2,168	1,915	1,877	2,090	2,288	2,307	1,929	1,115	926	1,060	1,487

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	16%	-6%	-3%	0%	0%	0%	2%	-1%	-8%	5%	2%	-3%
20%	17%	-2%	-3%	0%	-1%	8%	5%	0%	-18%	0%	0%	0%
30%	18%	-5%	-6%	-1%	-3%	7%	2%	-3%	-4%	0%	0%	-1%
40%	20%	-4%	-5%	-2%	-1%	3%	2%	0%	-8%	0%	-1%	-1%
50%	21%	-7%	-7%	-6%	0%	-1%	0%	-3%	-4%	-1%	-1%	-1%
60%	23%	-3%	-6%	-2%	-3%	-1%	11%	-7%	-2%	-1%	-1%	0%
70%	28%	-4%	-2%	-2%	-6%	-2%	21%	-7%	-2%	-1%	-1%	0%
80%	25%	-2%	-4%	-2%	-1%	-2%	14%	-9%	2%	0%	-1%	0%
90%	31%	-2%	-2%	-2%	0%	-1%	6%	-11%	0%	-6%	0%	0%
Long Term												
Full Simulation Period ^b	19%	-4%	-3%	-1%	-1%	2%	4%	-1%	-8%	0%	1%	-1%
Water Year Types^c												
Wet (23%)	17%	-3%	-1%	-1%	0%	3%	0%	1%	-9%	1%	2%	-1%
Above Normal (24%)	18%	-5%	-3%	-1%	-1%	2%	3%	-2%	-7%	0%	0%	0%
Below Normal (10%)	22%	-6%	-4%	-3%	-2%	1%	8%	-2%	-7%	-1%	-1%	-1%
Dry (16%)	18%	-4%	-5%	-3%	-3%	-2%	13%	-6%	-2%	-1%	-1%	-1%
Critical (27%)	23%	-4%	-4%	-3%	-2%	-1%	14%	-9%	0%	-2%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.3.10.3 San Joaquin River at Vernalis, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,015	3,156	4,932	11,157	14,594	15,467	14,666	14,360	10,139	5,612	2,740	3,146
20%	2,692	2,843	2,953	4,819	10,200	9,482	10,169	8,291	5,696	2,636	2,600	2,658
30%	2,520	2,663	2,541	3,655	6,300	7,933	8,421	5,676	3,488	1,990	1,897	2,503
40%	2,331	2,500	2,341	2,692	4,268	5,393	7,435	4,617	3,188	1,742	1,676	2,142
50%	2,157	2,386	2,257	2,544	3,420	3,883	6,016	4,043	2,349	1,506	1,500	1,944
60%	1,952	2,244	2,165	2,343	2,774	3,511	4,349	3,276	1,895	1,379	1,415	1,842
70%	1,752	2,141	2,027	2,153	2,443	2,963	3,119	2,891	1,485	1,170	1,321	1,743
80%	1,597	1,984	1,903	1,923	2,174	2,414	2,442	2,362	1,274	1,088	1,211	1,611
90%	1,411	1,793	1,699	1,733	1,945	2,230	1,779	1,890	1,085	941	1,071	1,478
Long Term												
Full Simulation Period ^b	2,241	2,721	3,492	5,136	6,700	7,131	7,255	6,101	4,547	2,625	1,838	2,238
Water Year Types^c												
Wet (23%)	2,497	3,627	6,644	11,506	15,763	16,308	15,374	14,433	12,512	6,641	3,078	3,456
Above Normal (24%)	2,288	2,532	2,757	4,947	6,946	7,415	8,260	5,348	3,525	1,999	1,977	2,352
Below Normal (10%)	2,086	2,397	3,810	3,608	3,723	4,101	5,842	4,213	2,225	1,481	1,457	1,856
Dry (16%)	2,339	2,684	2,347	2,487	2,628	3,304	3,551	2,976	1,714	1,267	1,362	1,789
Critical (27%)	1,974	2,251	1,998	1,927	2,138	2,311	2,031	2,122	1,116	943	1,059	1,485

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,023	3,053	4,949	12,089	17,246	15,467	14,936	14,309	10,004	6,473	3,525	3,287
20%	2,667	2,830	2,938	4,833	10,213	9,874	10,251	7,931	4,627	2,495	2,587	2,623
30%	2,494	2,583	2,421	3,540	6,797	7,753	8,532	5,438	2,558	1,926	1,892	2,464
40%	2,328	2,478	2,304	2,753	4,210	5,305	7,580	4,344	2,294	1,722	1,667	2,125
50%	2,137	2,313	2,191	2,439	3,215	3,847	6,112	3,821	1,955	1,506	1,495	1,932
60%	1,956	2,244	2,140	2,236	2,668	3,440	4,501	2,907	1,700	1,361	1,415	1,838
70%	1,782	2,148	2,012	2,088	2,360	2,906	3,355	2,502	1,364	1,164	1,319	1,743
80%	1,609	1,974	1,886	1,824	2,090	2,371	2,581	2,158	1,241	1,026	1,211	1,612
90%	1,466	1,763	1,669	1,639	1,849	2,205	1,936	1,650	1,001	930	1,065	1,477
Long Term												
Full Simulation Period ^b	2,252	2,683	3,501	5,108	6,872	7,145	7,431	5,830	4,009	2,655	1,882	2,271
Water Year Types^c												
Wet (23%)	2,505	3,604	6,760	11,512	16,584	16,445	15,425	14,237	11,476	6,916	3,267	3,610
Above Normal (24%)	2,310	2,488	2,775	4,925	6,937	7,444	8,476	5,078	2,579	1,910	1,972	2,341
Below Normal (10%)	2,067	2,299	3,711	3,708	3,857	4,057	6,015	3,856	1,865	1,472	1,454	1,834
Dry (16%)	2,346	2,646	2,309	2,419	2,607	3,241	3,785	2,611	1,568	1,253	1,360	1,782
Critical (27%)	1,991	2,227	1,974	1,842	2,043	2,273	2,247	1,874	1,080	912	1,067	1,497

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	-3%	0%	8%	18%	0%	2%	0%	-1%	15%	29%	4%
20%	-1%	0%	-1%	0%	0%	4%	1%	-4%	-19%	-5%	0%	-1%
30%	-1%	-3%	-5%	-3%	8%	-2%	1%	-4%	-27%	-3%	0%	-2%
40%	0%	-1%	-2%	2%	-1%	-2%	2%	-6%	-28%	-1%	-1%	-1%
50%	-1%	-3%	-3%	-4%	-6%	-1%	2%	-5%	-17%	0%	0%	-1%
60%	0%	0%	-1%	-5%	-4%	-2%	3%	-11%	-10%	-1%	0%	0%
70%	2%	0%	-1%	-3%	-3%	-2%	8%	-13%	-8%	0%	0%	0%
80%	1%	0%	-1%	-5%	-4%	-2%	6%	-9%	-3%	-6%	0%	0%
90%	4%	-2%	-2%	-5%	-5%	-1%	9%	-13%	-8%	-1%	-1%	0%
Long Term												
Full Simulation Period ^b	0%	-1%	0%	-1%	3%	0%	2%	-4%	-12%	1%	2%	1%
Water Year Types^c												
Wet (23%)	0%	-1%	2%	0%	5%	1%	0%	-1%	-8%	4%	6%	4%
Above Normal (24%)	1%	-2%	1%	0%	0%	0%	3%	-5%	-27%	-4%	0%	0%
Below Normal (10%)	-1%	-4%	-3%	3%	4%	-1%	3%	-8%	-16%	-1%	0%	-1%
Dry (16%)	0%	-1%	-2%	-3%	-1%	-2%	7%	-12%	-9%	-1%	0%	0%
Critical (27%)	1%	-1%	-1%	-4%	-4%	-2%	11%	-12%	-3%	-3%	1%	1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.3.10.4 San Joaquin River at Vernalis, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,015	3,156	4,932	11,157	14,594	15,467	14,666	14,360	10,139	5,612	2,740	3,146
20%	2,692	2,843	2,953	4,819	10,200	9,482	10,169	8,291	5,696	2,636	2,600	2,658
30%	2,520	2,663	2,541	3,655	6,300	7,933	8,421	5,676	3,488	1,990	1,897	2,503
40%	2,331	2,500	2,341	2,692	4,268	5,393	7,435	4,617	3,188	1,742	1,676	2,142
50%	2,157	2,386	2,257	2,544	3,420	3,883	6,016	4,043	2,349	1,506	1,500	1,944
60%	1,952	2,244	2,165	2,343	2,774	3,511	4,349	3,276	1,895	1,379	1,415	1,842
70%	1,752	2,141	2,027	2,153	2,443	2,963	3,119	2,891	1,485	1,170	1,321	1,743
80%	1,597	1,984	1,903	1,923	2,174	2,414	2,442	2,362	1,274	1,088	1,211	1,611
90%	1,411	1,793	1,699	1,733	1,945	2,230	1,779	1,890	1,085	941	1,071	1,478
Long Term												
Full Simulation Period ^b	2,241	2,721	3,492	5,136	6,700	7,131	7,255	6,101	4,547	2,625	1,838	2,238
Water Year Types^c												
Wet (23%)	2,497	3,627	6,644	11,506	15,763	16,308	15,374	14,433	12,512	6,641	3,078	3,456
Above Normal (24%)	2,288	2,532	2,757	4,947	6,946	7,415	8,260	5,348	3,525	1,999	1,977	2,352
Below Normal (10%)	2,086	2,397	3,810	3,608	3,723	4,101	5,842	4,213	2,225	1,481	1,457	1,856
Dry (16%)	2,339	2,684	2,347	2,487	2,628	3,304	3,551	2,976	1,714	1,267	1,362	1,789
Critical (27%)	1,974	2,251	1,998	1,927	2,138	2,311	2,031	2,122	1,116	943	1,059	1,485

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,495	2,953	4,804	11,129	14,597	15,473	14,976	14,176	9,351	5,773	2,776	3,084
20%	3,146	2,777	2,897	4,811	10,142	9,856	10,265	8,232	4,688	2,628	2,589	2,654
30%	2,938	2,527	2,401	3,610	6,118	8,461	8,576	5,670	3,364	1,985	1,904	2,488
40%	2,763	2,395	2,204	2,629	4,232	5,570	7,567	5,162	2,947	1,735	1,666	2,125
50%	2,588	2,219	2,101	2,402	3,420	3,846	6,110	4,183	2,219	1,484	1,488	1,930
60%	2,385	2,169	2,046	2,289	2,683	3,459	5,047	3,554	1,860	1,365	1,402	1,835
70%	2,196	2,059	1,979	2,083	2,303	2,906	4,317	2,916	1,447	1,155	1,307	1,739
80%	1,988	1,951	1,829	1,883	2,145	2,371	3,100	2,401	1,283	1,052	1,202	1,611
90%	1,849	1,763	1,669	1,699	1,947	2,204	2,461	2,245	1,000	885	1,025	1,431
Long Term												
Full Simulation Period ^b	2,660	2,609	3,371	5,071	6,639	7,235	7,686	6,290	4,174	2,597	1,818	2,213
Water Year Types^c												
Wet (23%)	2,903	3,513	6,448	11,445	15,743	16,679	15,389	14,666	11,287	6,580	3,020	3,379
Above Normal (24%)	2,691	2,411	2,679	4,897	6,864	7,536	8,487	5,671	3,280	1,989	1,975	2,345
Below Normal (10%)	2,531	2,249	3,661	3,506	3,650	4,149	6,299	4,206	2,062	1,462	1,446	1,837
Dry (16%)	2,750	2,569	2,232	2,400	2,547	3,241	4,420	3,245	1,672	1,253	1,346	1,776
Critical (27%)	2,418	2,163	1,910	1,871	2,078	2,288	2,741	2,177	1,090	916	1,051	1,480

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	16%	-6%	-3%	0%	0%	0%	2%	-1%	-8%	3%	1%	-2%
20%	17%	-2%	-2%	0%	-1%	4%	1%	-1%	-18%	0%	0%	0%
30%	17%	-5%	-6%	-1%	-3%	7%	2%	0%	-4%	0%	0%	-1%
40%	19%	-4%	-6%	-2%	-1%	3%	2%	12%	-8%	0%	-1%	-1%
50%	20%	-7%	-7%	-6%	0%	-1%	2%	3%	-6%	-1%	-1%	-1%
60%	22%	-3%	-6%	-2%	-3%	-1%	16%	8%	-2%	-1%	-1%	0%
70%	25%	-4%	-2%	-3%	-6%	-2%	38%	1%	-3%	-1%	-1%	0%
80%	24%	-2%	-4%	-2%	-1%	-2%	27%	2%	1%	-3%	-1%	0%
90%	31%	-2%	-2%	-2%	0%	-1%	38%	19%	-8%	-6%	-4%	-3%
Long Term												
Full Simulation Period ^b	19%	-4%	-3%	-1%	-1%	1%	6%	3%	-8%	-1%	-1%	-1%
Water Year Types^c												
Wet (23%)	16%	-3%	-3%	-1%	0%	2%	0%	2%	-10%	-1%	-2%	-2%
Above Normal (24%)	18%	-5%	-3%	-1%	-1%	2%	3%	6%	-7%	-1%	0%	0%
Below Normal (10%)	21%	-6%	-4%	-3%	-2%	1%	8%	0%	-7%	-1%	-1%	-1%
Dry (16%)	18%	-4%	-5%	-3%	-3%	-2%	24%	9%	-2%	-1%	-1%	-1%
Critical (27%)	22%	-4%	-4%	-3%	-3%	-1%	35%	3%	-2%	-3%	-1%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

5C.3.3.11 Old and Middle River Flow

Table 5C.3.3.11.1 Sacramento/San Joaquin River Delta Outflow, Monthly Outflow Volume

No Action Alternative

Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	614	893	4,094	6,333	7,834	5,445	4,160	2,848	1,180	763	277	1,161
20%	586	874	2,112	4,323	4,927	4,179	2,834	1,727	609	688	259	1,134
30%	576	825	1,003	3,149	3,624	2,834	1,795	1,200	548	573	246	909
40%	423	657	761	1,793	2,868	2,092	1,504	1,004	465	497	246	656
50%	270	586	611	1,299	2,037	1,676	1,197	843	431	492	246	261
60%	246	368	359	1,050	1,407	1,204	946	731	422	400	246	201
70%	246	268	315	800	1,023	1,061	758	592	408	307	246	179
80%	246	268	278	586	823	783	598	520	383	307	246	179
90%	184	210	277	486	633	662	564	446	334	246	240	179
Long Term												
Full Simulation Period ^b	401	686	1,416	2,720	3,186	2,697	1,812	1,281	648	495	258	565
Water Year Types^c												
Wet (32%)	520	1,020	2,913	5,509	5,771	5,000	3,288	2,394	1,120	655	273	1,133
Above Normal (16%)	332	742	1,502	3,049	3,807	3,236	1,938	1,201	485	667	251	662
Below Normal (13%)	471	650	582	1,077	2,048	1,113	1,019	789	445	508	254	211
Dry (24%)	341	470	471	981	1,443	1,396	999	680	431	315	257	191
Critical (15%)	253	296	418	723	861	747	559	410	348	249	235	179

Alternative 1

Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	357	895	4,054	6,567	8,061	5,795	3,950	2,541	1,167	670	268	260
20%	283	383	2,007	4,470	4,927	4,380	2,580	1,582	679	593	251	240
30%	264	327	950	2,828	3,382	2,653	1,494	954	588	515	246	234
40%	251	291	635	1,564	2,894	2,062	1,215	801	556	492	246	227
50%	246	268	477	1,080	1,904	1,621	855	734	507	475	246	219
60%	246	268	382	833	1,179	1,104	724	674	485	400	246	181
70%	246	268	314	673	908	901	597	563	433	307	246	179
80%	246	268	277	518	698	752	567	535	422	307	232	179
90%	211	208	277	405	562	601	528	437	377	246	215	179
Long Term												
Full Simulation Period ^b	286	506	1,408	2,595	3,126	2,682	1,611	1,161	705	458	252	237
Water Year Types^c												
Wet (32%)	340	791	3,011	5,453	5,779	5,081	3,010	2,178	1,209	605	271	319
Above Normal (16%)	253	566	1,391	2,845	3,822	3,311	1,615	1,026	562	601	249	224
Below Normal (13%)	291	433	545	879	2,062	1,078	813	719	533	437	255	206
Dry (24%)	260	296	439	815	1,269	1,236	879	635	454	310	242	191
Critical (15%)	240	244	364	670	690	680	525	386	346	248	231	179

Alternative 1 minus No Action Alternative

Statistic	Monthly Outflow Volume (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-42%	0%	-1%	4%	3%	6%	-5%	-11%	-1%	-12%	-3%	-78%
20%	-52%	-56%	-5%	3%	0%	5%	-9%	-8%	11%	-14%	-3%	-79%
30%	-54%	-60%	-5%	-10%	-7%	-6%	-17%	-21%	7%	-10%	0%	-74%
40%	-41%	-56%	-17%	-13%	1%	-1%	-19%	-20%	20%	-1%	0%	-65%
50%	-9%	-54%	-22%	-17%	-7%	-3%	-29%	-13%	18%	-3%	0%	-16%
60%	0%	-27%	6%	-21%	-16%	-8%	-23%	-8%	15%	0%	0%	-10%
70%	0%	0%	0%	-16%	-11%	-15%	-21%	-5%	6%	0%	0%	0%
80%	0%	0%	0%	-11%	-15%	-4%	-5%	3%	10%	0%	-6%	0%
90%	15%	-1%	0%	-17%	-11%	-9%	-6%	-2%	13%	0%	-10%	0%
Long Term												
Full Simulation Period ^b	-29%	-26%	-1%	-5%	-2%	-1%	-11%	-9%	9%	-8%	-2%	-58%
Water Year Types^c												
Wet (32%)	-35%	-22%	3%	-1%	0%	2%	-8%	-9%	8%	-8%	-1%	-72%
Above Normal (16%)	-24%	-24%	-7%	-7%	0%	2%	-17%	-15%	16%	-10%	-1%	-66%
Below Normal (13%)	-38%	-33%	-6%	-18%	1%	-3%	-20%	-9%	20%	-14%	0%	-3%
Dry (24%)	-24%	-37%	-7%	-17%	-12%	-11%	-12%	-7%	5%	-2%	0%	0%
Critical (15%)	-5%	-18%	-13%	-7%	-20%	-9%	-6%	-6%	-1%	0%	-2%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.11.2 Sacramento/San Joaquin River Delta Outflow, Monthly Outflow Volume

Second Basis of Comparison

Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	357	895	4,054	6,567	8,061	5,795	3,950	2,541	1,167	670	268	260
20%	283	383	2,007	4,470	4,927	4,380	2,580	1,582	679	593	251	240
30%	264	327	950	2,828	3,382	2,653	1,494	954	588	515	246	234
40%	251	291	635	1,564	2,894	2,062	1,215	801	556	492	246	227
50%	246	268	477	1,080	1,904	1,621	855	734	507	475	246	219
60%	246	268	382	833	1,179	1,104	724	674	485	400	246	181
70%	246	268	314	673	908	901	597	563	433	307	246	179
80%	246	268	277	518	698	752	567	535	422	307	232	179
90%	211	208	277	405	562	601	528	437	377	246	215	179
Long Term												
Full Simulation Period ^b	286	506	1,408	2,595	3,126	2,682	1,611	1,161	705	458	252	237
Water Year Types^c												
Wet (32%)	340	791	3,011	5,453	5,779	5,081	3,010	2,178	1,209	605	271	319
Above Normal (16%)	253	566	1,391	2,845	3,822	3,311	1,615	1,026	562	601	249	224
Below Normal (13%)	291	433	545	879	2,062	1,078	813	719	533	437	255	206
Dry (24%)	260	296	439	815	1,269	1,236	879	635	454	310	242	191
Critical (15%)	240	244	364	670	690	680	525	386	346	248	231	179

No Action Alternative

Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	614	893	4,094	6,333	7,834	5,445	4,160	2,848	1,180	763	277	1,161
20%	586	874	2,112	4,323	4,927	4,179	2,834	1,727	609	688	259	1,134
30%	576	825	1,003	3,149	3,624	2,834	1,795	1,200	548	573	246	909
40%	423	657	761	1,793	2,868	2,092	1,504	1,004	465	497	246	656
50%	270	586	611	1,299	2,037	1,676	1,197	843	431	492	246	261
60%	246	368	359	1,050	1,407	1,204	946	731	422	400	246	201
70%	246	268	315	800	1,023	1,061	758	592	408	307	246	179
80%	246	268	278	586	823	783	598	520	383	307	246	179
90%	184	210	277	486	633	662	564	446	334	246	240	179
Long Term												
Full Simulation Period ^b	401	686	1,416	2,720	3,186	2,697	1,812	1,281	648	495	258	565
Water Year Types^c												
Wet (32%)	520	1,020	2,913	5,509	5,771	5,000	3,288	2,394	1,120	655	273	1,133
Above Normal (16%)	332	742	1,502	3,049	3,807	3,236	1,938	1,201	485	667	251	662
Below Normal (13%)	471	650	582	1,077	2,048	1,113	1,019	789	445	508	254	211
Dry (24%)	341	470	471	981	1,443	1,396	999	680	431	315	257	191
Critical (15%)	253	296	418	723	861	747	559	410	348	249	235	179

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Outflow Volume (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	72%	0%	1%	-4%	-3%	-6%	5%	12%	1%	14%	3%	346%
20%	107%	128%	5%	-3%	0%	-5%	10%	9%	-10%	16%	3%	372%
30%	118%	152%	5%	11%	7%	7%	20%	26%	-7%	11%	0%	288%
40%	68%	126%	20%	15%	-1%	1%	24%	25%	-16%	1%	0%	189%
50%	10%	119%	28%	20%	7%	3%	40%	15%	-15%	4%	0%	19%
60%	0%	37%	-6%	26%	19%	9%	31%	8%	-13%	0%	0%	11%
70%	0%	0%	0%	19%	13%	18%	27%	5%	-6%	0%	0%	0%
80%	0%	0%	0%	13%	18%	4%	5%	-3%	-9%	0%	6%	0%
90%	-13%	1%	0%	20%	13%	10%	7%	2%	-12%	0%	11%	0%
Long Term												
Full Simulation Period ^b	40%	36%	1%	5%	2%	1%	12%	10%	-8%	8%	2%	139%
Water Year Types^c												
Wet (32%)	53%	29%	-3%	1%	0%	-2%	9%	10%	-7%	8%	1%	255%
Above Normal (16%)	31%	31%	8%	7%	0%	-2%	20%	17%	-14%	11%	1%	195%
Below Normal (13%)	62%	50%	7%	23%	-1%	3%	25%	10%	-17%	16%	0%	3%
Dry (24%)	31%	59%	7%	20%	14%	13%	14%	7%	-5%	2%	6%	0%
Critical (15%)	5%	21%	15%	8%	25%	10%	6%	6%	1%	0%	2%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.11.3 Sacramento/San Joaquin River Delta Outflow, Monthly Outflow Volume

Second Basis of Comparison

Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	357	895	4,054	6,567	8,061	5,795	3,950	2,541	1,167	670	268	260
20%	283	383	2,007	4,470	4,927	4,380	2,580	1,582	679	593	251	240
30%	264	327	950	2,828	3,382	2,653	1,494	954	588	515	246	234
40%	251	291	635	1,564	2,894	2,062	1,215	801	556	492	246	227
50%	246	268	477	1,080	1,904	1,621	855	734	507	475	246	219
60%	246	268	382	833	1,179	1,104	724	674	485	400	246	181
70%	246	268	314	673	908	901	597	563	433	307	246	179
80%	246	268	277	518	698	752	567	535	422	307	232	179
90%	211	208	277	405	562	601	528	437	377	246	215	179
Long Term												
Full Simulation Period ^b	286	506	1,408	2,595	3,126	2,682	1,611	1,161	705	458	252	237
Water Year Types^c												
Wet (32%)	340	791	3,011	5,453	5,779	5,081	3,010	2,178	1,209	605	271	319
Above Normal (16%)	253	566	1,391	2,845	3,822	3,311	1,615	1,026	562	601	249	224
Below Normal (13%)	291	433	545	879	2,062	1,078	813	719	533	437	255	206
Dry (24%)	260	296	439	815	1,269	1,236	879	635	454	310	242	191
Critical (15%)	240	244	364	670	690	680	525	386	346	248	231	179

Alternative 3

Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	298	902	4,155	6,646	7,924	5,788	3,812	2,471	1,066	729	265	261
20%	266	389	2,140	4,462	4,802	4,293	2,584	1,383	630	659	246	245
30%	257	319	1,154	3,104	3,795	2,714	1,525	913	572	575	246	235
40%	246	290	722	1,875	3,031	2,137	1,238	750	502	492	246	229
50%	246	268	480	1,398	2,079	1,678	867	704	477	492	246	222
60%	246	268	398	1,061	1,416	1,185	754	630	436	428	246	191
70%	246	268	336	768	1,078	1,032	601	579	422	307	246	179
80%	246	268	277	599	821	789	566	493	409	307	241	179
90%	185	208	277	497	634	654	512	437	351	246	222	179
Long Term												
Full Simulation Period ^b	277	506	1,465	2,772	3,236	2,711	1,617	1,122	656	490	252	240
Water Year Types^c												
Wet (32%)	333	791	3,116	5,609	5,812	5,020	2,996	2,109	1,118	649	271	319
Above Normal (16%)	242	568	1,461	3,096	3,903	3,292	1,636	960	514	645	246	228
Below Normal (13%)	281	422	564	1,156	2,186	1,120	856	699	457	507	254	221
Dry (24%)	250	297	457	992	1,459	1,384	882	612	445	321	245	191
Critical (15%)	234	243	397	721	859	752	528	397	346	246	230	179

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Outflow Volume (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-16%	1%	2%	1%	-2%	0%	-3%	-3%	-9%	9%	-1%	0%
20%	-6%	2%	7%	0%	-3%	-2%	0%	-13%	-7%	11%	-2%	2%
30%	-3%	-3%	21%	10%	12%	2%	2%	-4%	-3%	12%	0%	0%
40%	-2%	0%	14%	20%	5%	4%	2%	-6%	-10%	0%	0%	1%
50%	0%	0%	1%	29%	9%	3%	1%	-4%	-6%	4%	0%	1%
60%	0%	0%	4%	27%	20%	7%	4%	-7%	-10%	7%	0%	6%
70%	0%	0%	7%	14%	19%	14%	1%	3%	-2%	0%	0%	0%
80%	0%	0%	0%	16%	18%	5%	0%	-8%	-3%	0%	4%	0%
90%	-13%	0%	0%	23%	13%	9%	-3%	0%	-7%	0%	3%	0%
Long Term												
Full Simulation Period ^b	-3%	0%	4%	7%	4%	1%	0%	-3%	-7%	7%	0%	1%
Water Year Types^c												
Wet (32%)	-2%	0%	4%	3%	1%	-1%	0%	-3%	-8%	7%	0%	0%
Above Normal (16%)	-4%	0%	5%	9%	2%	-1%	1%	-7%	-9%	7%	-1%	1%
Below Normal (13%)	-4%	-3%	4%	32%	6%	4%	5%	-3%	-14%	16%	0%	7%
Dry (24%)	-4%	0%	4%	22%	15%	12%	0%	-4%	-2%	4%	1%	0%
Critical (15%)	-2%	0%	9%	8%	25%	11%	1%	3%	0%	-1%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.11.4 Sacramento/San Joaquin River Delta Outflow, Monthly Outflow Volume

Second Basis of Comparison

Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	357	895	4,054	6,567	8,061	5,795	3,950	2,541	1,167	670	268	260
20%	283	383	2,007	4,470	4,927	4,380	2,580	1,582	679	593	251	240
30%	264	327	950	2,828	3,382	2,653	1,494	954	588	515	246	234
40%	251	291	635	1,564	2,894	2,062	1,215	801	556	492	246	227
50%	246	268	477	1,080	1,904	1,621	855	734	507	475	246	219
60%	246	268	382	833	1,179	1,104	724	674	485	400	246	181
70%	246	268	314	673	908	901	597	563	433	307	246	179
80%	246	268	277	518	698	752	567	535	422	307	232	179
90%	211	208	277	405	562	601	528	437	377	246	215	179
Long Term												
Full Simulation Period ^b	286	506	1,408	2,595	3,126	2,682	1,611	1,161	705	458	252	237
Water Year Types^c												
Wet (32%)	340	791	3,011	5,453	5,779	5,081	3,010	2,178	1,209	605	271	319
Above Normal (16%)	253	566	1,391	2,845	3,822	3,311	1,615	1,026	562	601	249	224
Below Normal (13%)	291	433	545	879	2,062	1,078	813	719	533	437	255	206
Dry (24%)	260	296	439	815	1,269	1,236	879	635	454	310	242	191
Critical (15%)	240	244	364	670	690	680	525	386	346	248	231	179

Alternative 5

Statistic	Monthly Outflow Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	623	960	4,115	6,339	7,831	5,439	4,160	2,849	1,180	767	284	1,161
20%	594	874	2,112	4,319	4,907	4,174	2,807	1,763	606	688	256	1,134
30%	576	830	1,008	3,149	3,653	2,835	1,798	1,237	524	593	246	910
40%	423	660	762	1,785	2,869	2,092	1,542	1,002	453	501	246	651
50%	257	586	616	1,301	2,053	1,666	1,234	873	423	492	246	255
60%	246	369	359	1,048	1,406	1,203	1,028	776	422	400	246	204
70%	246	268	310	800	1,025	1,057	817	629	401	308	246	179
80%	246	268	286	585	823	783	712	561	370	307	246	179
90%	184	211	277	486	633	662	623	462	330	246	230	179
Long Term												
Full Simulation Period ^b	401	690	1,413	2,714	3,184	2,695	1,848	1,312	642	500	257	565
Water Year Types^c												
Wet (32%)	517	1,020	2,905	5,499	5,773	4,996	3,288	2,411	1,117	667	273	1,132
Above Normal (16%)	334	767	1,505	3,048	3,795	3,232	1,947	1,223	482	668	251	661
Below Normal (13%)	471	650	582	1,075	2,047	1,110	1,061	821	434	513	254	214
Dry (24%)	342	471	467	980	1,444	1,396	1,081	720	423	316	256	191
Critical (15%)	254	296	418	714	856	747	621	462	346	249	233	179

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Outflow Volume (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	75%	7%	2%	-3%	-3%	-6%	5%	12%	1%	14%	6%	346%
20%	110%	128%	5%	-3%	0%	-5%	9%	11%	-11%	16%	2%	372%
30%	118%	154%	6%	11%	8%	7%	20%	30%	-11%	15%	0%	288%
40%	68%	127%	20%	14%	-1%	1%	27%	25%	-19%	2%	0%	186%
50%	5%	119%	29%	20%	8%	3%	44%	19%	-17%	4%	0%	17%
60%	0%	38%	-6%	26%	19%	9%	42%	15%	-13%	0%	0%	13%
70%	0%	0%	-1%	19%	13%	17%	37%	12%	-7%	0%	0%	0%
80%	0%	0%	3%	13%	18%	4%	25%	5%	-12%	0%	6%	0%
90%	-13%	1%	0%	20%	13%	10%	18%	6%	-13%	0%	7%	0%
Long Term												
Full Simulation Period ^b	40%	36%	0%	5%	2%	0%	15%	13%	-9%	9%	2%	138%
Water Year Types^c												
Wet (32%)	52%	29%	-3%	1%	0%	-2%	9%	11%	-8%	10%	1%	255%
Above Normal (16%)	32%	35%	8%	7%	-1%	-2%	21%	19%	-14%	11%	1%	195%
Below Normal (13%)	62%	50%	7%	22%	-1%	3%	31%	14%	-19%	17%	0%	4%
Dry (24%)	31%	59%	6%	20%	14%	13%	23%	13%	-7%	2%	6%	0%
Critical (15%)	6%	21%	15%	7%	24%	10%	18%	20%	0%	0%	1%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

5C.3.3.12 X2 Position

Table 5C.3.3.12.1 X2, End of Month Position

No Action Alternative

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	93.4	93.6	90.8	84.0	77.3	75.9	78.1	81.0	83.1	86.5	89.7	91.9
20%	91.8	91.4	87.6	82.3	71.7	72.8	73.6	79.3	81.8	84.9	88.1	91.1
30%	91.6	90.9	83.9	79.8	67.2	65.7	70.0	77.3	81.0	84.3	87.5	90.6
40%	91.1	88.1	82.5	73.5	64.0	64.5	66.7	72.3	80.2	82.4	86.2	90.1
50%	89.7	81.1	81.1	71.2	58.5	59.9	64.7	69.9	77.8	80.6	84.8	88.5
60%	81.0	81.0	79.7	64.4	55.2	58.0	60.9	66.3	76.6	78.1	84.6	81.0
70%	74.1	75.1	72.0	55.1	51.9	53.9	58.0	63.8	73.4	77.4	84.1	74.1
80%	74.0	74.0	62.2	51.3	49.4	50.6	53.8	59.1	69.8	76.8	82.7	74.0
90%	74.0	74.0	52.8	49.4	48.2	49.0	49.9	53.3	63.5	74.6	82.2	74.0
Long Term												
Full Simulation Period ^b	84.2	82.3	76.4	68.0	61.1	61.4	64.2	68.8	75.9	80.4	85.4	83.9
Water Year Types^c												
Wet (32%)	73.9	72.9	71.1	54.8	51.2	53.1	55.1	58.4	67.4	74.9	82.7	73.9
Above Normal (16%)	81.0	79.3	75.9	61.0	54.9	55.3	59.1	65.2	75.3	77.9	83.1	74.7
Below Normal (13%)	89.1	87.6	78.8	74.6	64.3	66.9	69.0	72.9	79.1	81.1	85.1	89.3
Dry (24%)	91.5	86.9	75.4	77.7	67.7	65.4	68.8	74.5	80.1	84.5	87.6	90.5
Critical (15%)	93.6	93.6	87.8	82.0	75.3	74.6	77.7	82.3	85.2	87.9	90.3	92.1

Alternative 1

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	92.6	93.1	90.9	87.3	80.8	78.5	78.7	81.5	83.5	86.7	89.9	92.0
20%	91.9	91.4	90.6	85.8	75.6	73.6	75.2	79.5	81.6	84.8	88.6	91.5
30%	91.4	91.0	89.6	83.3	72.0	68.3	73.1	78.5	80.6	84.3	88.0	91.0
40%	91.0	90.8	88.6	78.8	66.2	66.5	69.7	75.3	78.7	82.0	86.6	90.1
50%	90.5	90.3	86.7	75.6	61.4	61.6	67.4	72.9	77.8	80.9	85.3	89.5
60%	90.3	89.6	82.5	67.7	55.7	57.8	64.1	69.2	76.2	79.1	84.7	89.0
70%	90.0	89.1	76.9	56.2	52.4	54.1	59.7	66.0	74.4	78.3	84.5	88.7
80%	89.6	88.0	65.9	52.0	49.3	50.4	54.7	60.2	71.4	77.3	84.0	88.4
90%	88.2	79.6	53.3	49.5	48.3	48.8	50.4	54.6	63.9	74.7	83.0	87.8
Long Term												
Full Simulation Period ^b	90.0	87.6	79.5	70.3	62.9	62.3	65.9	70.6	75.8	80.6	85.9	89.3
Water Year Types^c												
Wet (32%)	87.8	84.8	75.8	55.7	51.6	53.0	56.4	60.2	67.2	75.2	83.3	86.7
Above Normal (16%)	90.3	87.9	80.5	63.6	56.0	55.2	61.2	67.9	75.1	78.2	83.8	81.9
Below Normal (13%)	89.4	88.6	80.6	78.7	66.4	67.6	71.3	74.9	78.2	81.3	85.9	89.7
Dry (24%)	91.2	87.2	76.9	81.1	70.8	67.5	70.7	75.9	80.2	84.4	88.1	90.9
Critical (15%)	93.1	93.4	89.8	83.6	78.1	76.7	78.8	83.3	85.7	88.2	90.6	92.3

Alternative 1 minus No Action Alternative

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-0.7	-0.5	0.1	3.3	3.5	2.6	0.5	0.5	0.3	0.2	0.2	0.1
20%	0.1	-0.1	3.0	3.6	3.9	0.8	1.6	0.3	-0.2	-0.1	0.5	0.4
30%	-0.2	0.1	5.6	3.5	4.8	2.5	3.1	1.3	-0.4	0.0	0.6	0.4
40%	-0.1	2.7	6.1	5.3	2.2	2.0	3.0	3.0	-1.5	-0.4	0.3	0.0
50%	0.8	9.2	5.6	4.4	3.0	1.7	2.7	3.0	0.0	0.3	0.5	1.1
60%	9.3	8.6	2.7	3.4	0.5	-0.2	3.3	2.9	-0.4	1.0	0.1	8.0
70%	15.9	14.0	5.0	1.1	0.5	0.2	1.7	2.2	1.0	0.9	0.4	14.6
80%	15.6	13.9	3.6	0.7	-0.1	-0.2	0.9	1.0	1.6	0.4	1.3	14.4
90%	14.2	5.6	0.5	0.1	0.1	-0.2	0.5	1.2	0.4	0.1	0.8	13.8
Long Term												
Full Simulation Period ^b	5.8	5.3	3.1	2.4	1.8	0.9	1.7	1.8	-0.1	0.2	0.5	5.4
Water Year Types^c												
Wet	13.9	11.9	4.7	0.9	0.4	0.0	1.3	1.9	-0.1	0.4	0.5	12.7
Above Normal	9.3	8.6	4.5	2.6	1.1	0.0	2.1	2.7	-0.2	0.3	0.7	7.2
Below Normal	0.3	1.0	1.8	4.2	2.1	0.8	2.3	2.0	-0.9	0.2	0.8	0.4
Dry	-0.2	0.3	1.5	3.5	3.2	2.2	1.9	1.4	0.1	-0.1	0.4	0.3
Critical	-0.5	-0.2	2.0	1.6	2.9	2.2	1.2	0.9	0.5	0.3	0.3	0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) X2 is defined as the position of the 2% (grams of salt per kilogram of seawater) bottom salinity value along the axis of the estuary; measured in kilometers from the Golden Gate Bridge. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.12.2 X2, End of Month Position

Second Basis of Comparison

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	92.6	93.1	90.9	87.3	80.8	78.5	78.7	81.5	83.5	86.7	89.9	92.0
20%	91.9	91.4	90.6	85.8	75.6	73.6	75.2	79.5	81.6	84.8	88.6	91.5
30%	91.4	91.0	89.6	83.3	72.0	68.3	73.1	78.5	80.6	84.3	88.0	91.0
40%	91.0	90.8	88.6	78.8	66.2	66.5	69.7	75.3	78.7	82.0	86.6	90.1
50%	90.5	90.3	86.7	75.6	61.4	61.6	67.4	72.9	77.8	80.9	85.3	89.5
60%	90.3	89.6	82.5	67.7	55.7	57.8	64.1	69.2	76.2	79.1	84.7	89.0
70%	90.0	89.1	76.9	56.2	52.4	54.1	59.7	66.0	74.4	78.3	84.5	88.7
80%	89.6	88.0	65.9	52.0	49.3	50.4	54.7	60.2	71.4	77.3	84.0	88.4
90%	88.2	79.6	53.3	49.5	48.3	48.8	50.4	54.6	63.9	74.7	83.0	87.8
Long Term												
Full Simulation Period ^b	90.0	87.6	79.5	70.3	62.9	62.3	65.9	70.6	75.8	80.6	85.9	89.3
Water Year Types^c												
Wet (32%)	87.8	84.8	75.8	55.7	51.6	53.0	56.4	60.2	67.2	75.2	83.3	86.7
Above Normal (16%)	90.3	87.9	80.5	63.6	56.0	55.2	61.2	67.9	75.1	78.2	83.8	81.9
Below Normal (13%)	89.4	88.6	80.6	78.7	66.4	67.6	71.3	74.9	78.2	81.3	85.9	89.7
Dry (24%)	91.2	87.2	76.9	81.1	70.8	67.5	70.7	75.9	80.2	84.4	88.1	90.9
Critical (15%)	93.1	93.4	89.8	83.6	78.1	76.7	78.8	83.3	85.7	88.2	90.6	92.3

No Action Alternative

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	93.4	93.6	90.8	84.0	77.3	75.9	78.1	81.0	83.1	86.5	89.7	91.9
20%	91.8	91.4	87.6	82.3	71.7	72.8	73.6	79.3	81.8	84.9	88.1	91.1
30%	91.6	90.9	83.9	79.8	67.2	65.7	70.0	77.3	81.0	84.3	87.5	90.6
40%	91.1	88.1	82.5	73.5	64.0	64.5	66.7	72.3	80.2	82.4	86.2	90.1
50%	89.7	81.1	81.1	71.2	58.5	59.9	64.7	69.9	77.8	80.6	84.8	88.5
60%	81.0	81.0	79.7	64.4	55.2	58.0	60.9	66.3	76.6	78.1	84.6	81.0
70%	74.1	75.1	72.0	55.1	51.9	53.9	58.0	63.8	73.4	77.4	84.1	74.1
80%	74.0	74.0	62.2	51.3	49.4	50.6	53.8	59.1	69.8	76.8	82.7	74.0
90%	74.0	74.0	52.8	49.4	48.2	49.0	49.9	53.3	63.5	74.6	82.2	74.0
Long Term												
Full Simulation Period ^b	84.2	82.3	76.4	68.0	61.1	61.4	64.2	68.8	75.9	80.4	85.4	83.9
Water Year Types^c												
Wet (32%)	73.9	72.9	71.1	54.8	51.2	53.1	55.1	58.4	67.4	74.9	82.7	73.9
Above Normal (16%)	81.0	79.3	75.9	61.0	54.9	55.3	59.1	65.2	75.3	77.9	83.1	74.7
Below Normal (13%)	89.1	87.6	78.8	74.6	64.3	66.9	69.0	72.9	79.1	81.1	85.1	89.3
Dry (24%)	91.5	86.9	75.4	77.7	67.7	65.4	68.8	74.5	80.1	84.5	87.6	90.5
Critical (15%)	93.6	93.6	87.8	82.0	75.3	74.6	77.7	82.3	85.2	87.9	90.3	92.1

No Action Alternative minus Second Basis of Comparison

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.7	0.5	-0.1	-3.3	-3.5	-2.6	-0.5	-0.5	-0.3	-0.2	-0.2	-0.1
20%	-0.1	0.1	-3.0	-3.6	-3.9	-0.8	-1.6	-0.3	0.2	0.1	-0.5	-0.4
30%	0.2	-0.1	-5.6	-3.5	-4.8	-2.5	-3.1	-1.3	0.4	0.0	-0.6	-0.4
40%	0.1	-2.7	-6.1	-5.3	-2.2	-2.0	-3.0	-3.0	1.5	0.4	-0.3	0.0
50%	-0.8	-9.2	-5.6	-4.4	-3.0	-1.7	-2.7	-3.0	0.0	-0.3	-0.5	-1.1
60%	-9.3	-8.6	-2.7	-3.4	-0.5	0.2	-3.3	-2.9	0.4	-1.0	-0.1	-8.0
70%	-15.9	-14.0	-5.0	-1.1	-0.5	-0.2	-1.7	-2.2	-1.0	-0.9	-0.4	-14.6
80%	-15.6	-13.9	-3.6	-0.7	0.1	0.2	-0.9	-1.0	-1.6	-0.4	-1.3	-14.4
90%	-14.2	-5.6	-0.5	-0.1	-0.1	0.2	-0.5	-1.2	-0.4	-0.1	-0.8	-13.8
Long Term												
Full Simulation Period ^b	-5.8	-5.3	-3.1	-2.4	-1.8	-0.9	-1.7	-1.8	0.1	-0.2	-0.5	-5.4
Water Year Types^c												
Wet	-13.9	-11.9	-4.7	-0.9	-0.4	0.0	-1.3	-1.9	0.1	-0.4	-0.5	-12.7
Above Normal	-9.3	-8.6	-4.5	-2.6	-1.1	0.0	-2.1	-2.7	0.2	-0.3	-0.7	-7.2
Below Normal	-0.3	-1.0	-1.8	-4.2	-2.1	-0.8	-2.3	-2.0	0.9	-0.2	-0.8	-0.4
Dry	0.2	-0.3	-1.5	-3.5	-3.2	-2.2	-1.9	-1.4	-0.1	0.1	-0.4	-0.3
Critical	0.5	0.2	-2.0	-1.6	-2.9	-2.2	-1.2	-0.9	-0.5	-0.3	-0.3	-0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) X2 is defined as the position of the 2% (grams of salt per kilogram of seawater) bottom salinity value along the axis of the estuary; measured in kilometers from the Golden Gate Bridge. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.12.3 X2, End of Month Position

Second Basis of Comparison

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	92.6	93.1	90.9	87.3	80.8	78.5	78.7	81.5	83.5	86.7	89.9	92.0
20%	91.9	91.4	90.6	85.8	75.6	73.6	75.2	79.5	81.6	84.8	88.6	91.5
30%	91.4	91.0	89.6	83.3	72.0	68.3	73.1	78.5	80.6	84.3	88.0	91.0
40%	91.0	90.8	88.6	78.8	66.2	66.5	69.7	75.3	78.7	82.0	86.6	90.1
50%	90.5	90.3	86.7	75.6	61.4	61.6	67.4	72.9	77.8	80.9	85.3	89.5
60%	90.3	89.6	82.5	67.7	55.7	57.8	64.1	69.2	76.2	79.1	84.7	89.0
70%	90.0	89.1	76.9	56.2	52.4	54.1	59.7	66.0	74.4	78.3	84.5	88.7
80%	89.6	88.0	65.9	52.0	49.3	50.4	54.7	60.2	71.4	77.3	84.0	88.4
90%	88.2	79.6	53.3	49.5	48.3	48.8	50.4	54.6	63.9	74.7	83.0	87.8
Long Term												
Full Simulation Period ^b	90.0	87.6	79.5	70.3	62.9	62.3	65.9	70.6	75.8	80.6	85.9	89.3
Water Year Types^c												
Wet (32%)	87.8	84.8	75.8	55.7	51.6	53.0	56.4	60.2	67.2	75.2	83.3	86.7
Above Normal (16%)	90.3	87.9	80.5	63.6	56.0	55.2	61.2	67.9	75.1	78.2	83.8	81.9
Below Normal (13%)	89.4	88.6	80.6	78.7	66.4	67.6	71.3	74.9	78.2	81.3	85.9	89.7
Dry (24%)	91.2	87.2	76.9	81.1	70.8	67.5	70.7	75.9	80.2	84.4	88.1	90.9
Critical (15%)	93.1	93.4	89.8	83.6	78.1	76.7	78.8	83.3	85.7	88.2	90.6	92.3

Alternative 3

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	93.2	93.6	90.8	86.1	77.8	75.8	78.2	81.5	83.2	86.4	90.0	92.2
20%	91.9	91.5	90.5	83.7	71.7	72.5	74.6	79.6	82.0	84.8	88.4	91.3
30%	91.6	91.1	89.4	81.5	67.6	66.1	71.3	78.4	81.0	84.3	87.7	90.8
40%	91.2	90.8	88.5	74.8	64.1	64.5	69.7	75.6	80.3	81.7	86.0	89.8
50%	90.7	90.6	86.7	71.8	58.8	60.0	67.3	73.1	78.8	80.7	84.9	89.3
60%	90.2	89.8	82.6	64.6	54.4	58.0	63.6	70.4	77.1	78.4	84.6	88.7
70%	89.9	89.0	74.2	55.1	52.2	54.4	59.9	66.8	75.1	77.8	84.2	88.4
80%	89.6	87.9	65.1	51.2	49.3	50.4	54.8	61.7	71.8	77.1	83.2	88.2
90%	88.2	79.6	53.0	49.5	48.1	48.8	50.4	54.8	64.9	75.0	82.4	87.6
Long Term												
Full Simulation Period ^b	90.1	87.8	79.0	68.5	61.2	61.4	65.5	70.8	76.5	80.5	85.6	89.1
Water Year Types^c												
Wet (32%)	87.8	84.8	75.3	54.8	51.3	53.1	56.5	60.8	68.3	75.1	82.9	86.6
Above Normal (16%)	90.3	88.0	80.0	61.5	54.9	55.0	60.9	68.4	76.2	78.0	83.4	81.8
Below Normal (13%)	89.2	88.8	80.2	75.4	64.0	66.6	70.5	74.9	79.6	81.0	85.1	89.2
Dry (24%)	91.4	87.4	76.4	78.8	67.9	65.5	69.9	76.0	80.4	84.3	87.8	90.8
Critical (15%)	93.4	93.7	89.3	82.7	75.6	74.6	78.1	82.8	85.4	88.0	90.5	92.3

Alternative 3 minus Second Basis of Comparison

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.5	0.5	-0.1	-1.2	-3.0	-2.7	-0.5	-0.1	-0.3	-0.3	0.1	0.2
20%	0.1	0.1	-0.1	-2.2	-3.9	-1.1	-0.6	0.1	0.4	0.0	-0.2	-0.2
30%	0.2	0.1	-0.1	-1.8	-4.4	-2.1	-1.8	-0.1	0.4	0.0	-0.4	-0.2
40%	0.2	0.0	-0.2	-4.0	-2.0	-2.1	0.0	0.3	1.6	-0.3	-0.5	-0.3
50%	0.2	0.3	0.0	-3.9	-2.6	-1.6	-0.2	0.3	1.0	-0.3	-0.4	-0.2
60%	-0.1	0.1	0.2	-3.1	-1.3	0.2	-0.5	1.2	0.9	-0.7	-0.1	-0.3
70%	-0.1	-0.1	-2.7	-1.1	-0.2	0.2	0.2	0.8	0.7	-0.5	-0.2	-0.2
80%	0.0	-0.1	-0.8	-0.8	0.0	0.1	0.1	1.5	0.3	-0.2	-0.8	-0.2
90%	0.0	0.0	-0.3	0.0	-0.2	0.0	0.0	0.2	1.0	0.2	-0.6	-0.1
Long Term												
Full Simulation Period ^b	0.1	0.1	-0.5	-1.8	-1.7	-1.0	-0.4	0.2	0.7	-0.2	-0.3	-0.2
Water Year Types^c												
Wet	0.0	0.0	-0.4	-0.9	-0.3	0.1	0.1	0.5	1.1	-0.1	-0.4	-0.1
Above Normal	0.0	0.1	-0.5	-2.1	-1.1	-0.2	-0.2	0.5	1.1	-0.2	-0.4	-0.1
Below Normal	-0.2	0.2	-0.5	-3.4	-2.4	-1.1	-0.8	0.1	1.4	-0.3	-0.7	-0.5
Dry	0.2	0.2	-0.5	-2.4	-2.9	-2.1	-0.8	0.1	0.3	-0.2	-0.2	-0.1
Critical	0.4	0.3	-0.6	-0.9	-2.5	-2.1	-0.7	-0.4	-0.3	-0.2	-0.1	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) X2 is defined as the position of the 2% (grams of salt per kilogram of seawater) bottom salinity value along the axis of the estuary; measured in kilometers from the Golden Gate Bridge. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.12.4 X2, End of Month Position

Second Basis of Comparison

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	92.6	93.1	90.9	87.3	80.8	78.5	78.7	81.5	83.5	86.7	89.9	92.0
20%	91.9	91.4	90.6	85.8	75.6	73.6	75.2	79.5	81.6	84.8	88.6	91.5
30%	91.4	91.0	89.6	83.3	72.0	68.3	73.1	78.5	80.6	84.3	88.0	91.0
40%	91.0	90.8	88.6	78.8	66.2	66.5	69.7	75.3	78.7	82.0	86.6	90.1
50%	90.5	90.3	86.7	75.6	61.4	61.6	67.4	72.9	77.8	80.9	85.3	89.5
60%	90.3	89.6	82.5	67.7	55.7	57.8	64.1	69.2	76.2	79.1	84.7	89.0
70%	90.0	89.1	76.9	56.2	52.4	54.1	59.7	66.0	74.4	78.3	84.5	88.7
80%	89.6	88.0	65.9	52.0	49.3	50.4	54.7	60.2	71.4	77.3	84.0	88.4
90%	88.2	79.6	53.3	49.5	48.3	48.8	50.4	54.6	63.9	74.7	83.0	87.8
Long Term												
Full Simulation Period ^b	90.0	87.6	79.5	70.3	62.9	62.3	65.9	70.6	75.8	80.6	85.9	89.3
Water Year Types^c												
Wet (32%)	87.8	84.8	75.8	55.7	51.6	53.0	56.4	60.2	67.2	75.2	83.3	86.7
Above Normal (16%)	90.3	87.9	80.5	63.6	56.0	55.2	61.2	67.9	75.1	78.2	83.8	81.9
Below Normal (13%)	89.4	88.6	80.6	78.7	66.4	67.6	71.3	74.9	78.2	81.3	85.9	89.7
Dry (24%)	91.2	87.2	76.9	81.1	70.8	67.5	70.7	75.9	80.2	84.4	88.1	90.9
Critical (15%)	93.1	93.4	89.8	83.6	78.1	76.7	78.8	83.3	85.7	88.2	90.6	92.3

Alternative 5

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	93.2	93.3	90.8	84.0	77.3	75.9	77.2	79.1	83.1	86.5	89.6	91.9
20%	91.9	91.5	87.6	82.3	71.7	72.8	72.5	77.9	81.4	84.9	88.1	91.1
30%	91.6	91.0	83.9	79.8	67.2	65.8	69.5	75.8	81.0	84.2	87.4	90.5
40%	91.0	88.0	82.4	73.5	63.9	64.5	66.4	71.5	79.6	82.3	86.1	90.0
50%	89.5	81.1	81.2	71.2	58.5	59.9	64.2	69.3	77.8	80.7	84.8	88.5
60%	81.0	81.0	79.7	64.4	55.1	57.9	60.8	66.4	76.6	78.2	84.6	81.0
70%	74.1	75.1	71.9	55.1	51.9	53.9	58.0	63.7	73.4	77.5	84.1	74.1
80%	74.0	74.1	62.2	51.3	49.4	50.6	53.5	58.9	69.8	76.8	82.6	74.0
90%	74.0	73.9	53.0	49.4	48.2	49.1	49.9	53.3	63.5	74.6	82.2	74.0
Long Term												
Full Simulation Period ^b	84.2	82.3	76.4	68.0	61.1	61.4	63.8	68.2	75.7	80.4	85.3	83.8
Water Year Types^c												
Wet (32%)	73.9	72.9	71.1	54.7	51.2	53.1	55.1	58.2	67.3	74.7	82.6	73.9
Above Normal (16%)	81.0	79.2	75.9	60.9	54.9	55.3	59.0	65.0	75.2	77.9	83.1	74.8
Below Normal (13%)	89.1	87.2	78.6	74.6	64.3	66.9	68.4	72.1	79.0	81.1	85.0	89.3
Dry (24%)	91.4	87.0	75.4	77.7	67.7	65.4	67.9	73.4	79.8	84.5	87.6	90.5
Critical (15%)	93.5	93.5	87.9	82.1	75.5	74.6	76.7	80.8	84.5	87.7	90.2	92.1

Alternative 5 minus Second Basis of Comparison

Statistic	End of Month Position (km)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.6	0.2	-0.1	-3.2	-3.5	-2.6	-1.5	-2.4	-0.4	-0.2	-0.3	-0.1
20%	0.0	0.1	-3.0	-3.6	-3.9	-0.8	-2.7	-1.6	-0.2	0.1	-0.4	-0.4
30%	0.2	0.0	-5.6	-3.5	-4.8	-2.5	-3.6	-2.7	0.4	-0.1	-0.6	-0.5
40%	0.0	-2.8	-6.3	-5.3	-2.2	-2.0	-3.2	-3.8	0.9	0.3	-0.5	-0.1
50%	-1.0	-9.2	-5.6	-4.4	-3.0	-1.7	-3.2	-3.5	0.0	-0.2	-0.5	-1.1
60%	-9.3	-8.7	-2.7	-3.3	-0.6	0.1	-3.4	-2.8	0.3	-0.9	-0.1	-8.0
70%	-16.0	-14.0	-5.1	-1.1	-0.5	-0.2	-1.7	-2.3	-1.0	-0.8	-0.4	-14.6
80%	-15.6	-13.9	-3.6	-0.8	0.1	0.2	-1.2	-1.3	-1.6	-0.5	-1.4	-14.4
90%	-14.2	-5.6	-0.3	-0.1	-0.1	0.3	-0.5	-1.2	-0.4	-0.1	-0.8	-13.8
Long Term												
Full Simulation Period ^b	-5.8	-5.4	-3.1	-2.3	-1.7	-0.9	-2.1	-2.4	-0.1	-0.3	-0.6	-5.4
Water Year Types^c												
Wet	-13.9	-11.9	-4.7	-1.0	-0.4	0.0	-1.3	-2.0	0.1	-0.5	-0.6	-12.7
Above Normal	-9.3	-8.6	-4.5	-2.6	-1.1	0.0	-2.1	-2.9	0.1	-0.3	-0.7	-7.1
Below Normal	-0.3	-1.4	-2.0	-4.2	-2.1	-0.7	-2.9	-2.8	0.8	-0.2	-0.9	-0.4
Dry	0.2	-0.2	-1.5	-3.4	-3.1	-2.1	-2.8	-2.5	-0.3	0.1	-0.5	-0.4
Critical	0.4	0.1	-2.0	-1.5	-2.7	-2.1	-2.1	-2.5	-1.2	-0.5	-0.4	-0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) X2 is defined as the position of the 2% (grams of salt per kilogram of seawater) bottom salinity value along the axis of the estuary; measured in kilometers from the Golden Gate Bridge. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

5C.3.3.13 Delta Outflow

Table 5C.3.3.13.1 Old and Middle River, Monthly Flow

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-3,764	-3,724	-3,812	-2,823	-666	-969	3,205	2,797	-1,150	-4,130	-2,453	-3,775
20%	-4,076	-4,560	-4,673	-2,823	-1,771	-1,394	2,207	1,304	-1,570	-6,849	-4,032	-5,147
30%	-4,613	-5,156	-5,244	-3,355	-2,823	-2,738	1,632	561	-3,500	-7,647	-5,770	-6,006
40%	-4,820	-5,627	-5,871	-4,392	-3,314	-3,500	1,268	108	-3,500	-8,888	-7,996	-7,621
50%	-5,328	-6,320	-5,871	-4,710	-3,781	-3,500	612	-182	-3,500	-9,376	-9,956	-9,000
60%	-5,589	-6,564	-5,871	-5,000	-4,878	-4,568	-102	-483	-4,487	-9,746	-10,630	-9,256
70%	-6,253	-7,101	-7,413	-5,000	-5,000	-5,000	-448	-632	-5,000	-10,301	-10,737	-9,653
80%	-6,560	-8,185	-9,537	-5,000	-5,000	-5,000	-995	-1,129	-5,000	-10,602	-10,853	-9,884
90%	-7,404	-9,995	-9,681	-5,000	-5,000	-5,000	-1,247	-1,414	-5,000	-11,108	-11,083	-10,032
Long Term												
Full Simulation Period ^b	-5,476	-6,380	-6,228	-3,535	-2,905	-2,690	919	310	-3,577	-8,496	-7,975	-7,706
Water Year Types^c												
Wet (32%)	-5,847	-7,229	-5,526	-1,900	-1,991	-1,552	3,110	2,011	-4,274	-8,957	-10,532	-9,358
Above Normal (16%)	-5,525	-6,801	-6,850	-3,699	-3,161	-4,176	1,196	412	-4,525	-9,151	-10,873	-9,542
Below Normal (13%)	-5,488	-6,749	-7,669	-4,380	-3,477	-3,919	165	-316	-3,445	-10,539	-9,624	-8,178
Dry (24%)	-5,440	-5,953	-6,676	-4,621	-3,573	-3,072	-670	-906	-3,350	-8,900	-4,745	-6,453
Critical (15%)	-4,671	-4,458	-5,006	-4,314	-2,968	-1,780	-786	-887	-1,539	-4,242	-3,168	-3,793

Alternative 1

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-3,392	-4,293	-4,109	-2,581	-1,241	-119	-2,051	-1,611	-2,184	-3,454	-2,880	-3,666
20%	-4,079	-5,433	-6,043	-4,838	-2,865	-1,287	-3,131	-2,897	-2,834	-5,152	-4,631	-5,107
30%	-4,769	-6,994	-6,917	-6,279	-4,367	-3,292	-3,957	-4,177	-3,308	-6,488	-5,837	-6,393
40%	-6,409	-7,620	-7,554	-7,434	-5,806	-4,012	-4,821	-4,673	-4,258	-7,155	-6,876	-8,264
50%	-7,303	-8,686	-8,173	-8,257	-6,422	-4,958	-5,864	-5,200	-4,990	-8,014	-7,941	-9,257
60%	-8,076	-9,256	-8,969	-8,848	-7,346	-5,373	-6,549	-5,517	-5,660	-8,914	-9,236	-9,689
70%	-9,075	-9,598	-9,326	-9,269	-8,323	-6,205	-7,131	-6,008	-6,016	-9,492	-10,081	-9,977
80%	-9,905	-9,959	-9,508	-9,585	-8,873	-6,616	-7,635	-6,451	-6,534	-10,052	-10,364	-10,089
90%	-10,146	-10,023	-9,665	-9,803	-9,509	-7,592	-7,991	-7,302	-6,936	-10,637	-10,683	-10,163
Long Term												
Full Simulation Period ^b	-6,980	-7,844	-7,429	-6,650	-5,206	-3,727	-5,381	-4,842	-4,611	-7,538	-7,489	-7,917
Water Year Types^c												
Wet (32%)	-8,038	-9,112	-7,723	-4,985	-3,160	-1,004	-6,895	-6,376	-4,024	-8,414	-9,609	-9,678
Above Normal (16%)	-6,419	-7,887	-7,960	-8,266	-6,089	-5,331	-7,034	-5,761	-6,024	-8,921	-9,947	-9,886
Below Normal (13%)	-8,051	-8,891	-8,088	-8,590	-5,749	-5,501	-5,370	-4,954	-6,578	-10,111	-8,035	-8,118
Dry (24%)	-6,466	-7,140	-7,171	-7,358	-6,832	-5,646	-4,159	-3,813	-4,591	-6,827	-5,191	-6,639
Critical (15%)	-5,171	-5,266	-6,040	-5,551	-5,474	-3,067	-2,358	-2,134	-2,583	-2,973	-3,561	-3,911

Alternative 1 minus No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	373	-569	-298	241	-575	850	-5,257	-4,408	-1,033	675	-426	109
20%	-3	-873	-1,370	-2,015	-1,094	107	-5,338	-4,202	-1,264	1,697	-599	39
30%	-156	-1,838	-1,673	-2,924	-1,545	-554	-5,589	-4,738	192	1,159	-67	-387
40%	-1,588	-1,993	-1,683	-3,042	-2,492	-512	-6,090	-4,781	-758	1,733	1,120	-644
50%	-1,975	-2,366	-2,302	-3,548	-2,641	-1,458	-6,475	-5,018	-1,490	1,362	2,016	-257
60%	-2,487	-2,692	-3,098	-3,848	-2,467	-806	-6,447	-5,034	-1,173	831	1,394	-433
70%	-2,822	-2,497	-1,913	-4,269	-3,323	-1,205	-6,682	-5,376	-1,016	809	656	-325
80%	-3,345	-1,773	29	-4,585	-3,873	-1,616	-6,640	-5,322	-1,534	550	489	-205
90%	-2,742	-28	16	-4,803	-4,509	-2,592	-6,744	-5,887	-1,936	471	400	-132
Long Term												
Full Simulation Period ^b	-1,504	-1,464	-1,201	-3,115	-2,301	-1,037	-6,300	-5,152	-1,034	958	486	-211
Water Year Types^c												
Wet (32%)	-2,191	-1,882	-2,198	-3,084	-1,169	549	-10,005	-8,387	250	543	923	-320
Above Normal (16%)	-895	-1,086	-1,110	-4,566	-2,928	-1,155	-8,229	-6,173	-1,499	230	926	-344
Below Normal (13%)	-2,563	-2,142	-419	-4,210	-2,273	-1,582	-5,535	-4,638	-3,133	429	1,589	59
Dry (24%)	-1,026	-1,187	-495	-2,737	-3,259	-2,574	-3,489	-2,907	-1,241	2,073	-446	-186
Critical (15%)	-500	-809	-1,034	-1,237	-2,505	-1,287	-1,572	-1,247	-1,044	1,268	-394	-118

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.13.2 Old and Middle River, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-3,392	-4,293	-4,109	-2,581	-1,241	-119	-2,051	-1,611	-2,184	-3,454	-2,880	-3,666
20%	-4,079	-5,433	-6,043	-4,838	-2,865	-1,287	-3,131	-2,897	-2,834	-5,152	-4,631	-5,107
30%	-4,769	-6,994	-6,917	-6,279	-4,367	-3,292	-3,957	-4,177	-3,308	-6,488	-5,837	-6,393
40%	-6,409	-7,620	-7,554	-7,434	-5,806	-4,012	-4,821	-4,673	-4,258	-7,155	-6,876	-8,264
50%	-7,303	-8,686	-8,173	-8,257	-6,422	-4,958	-5,864	-5,200	-4,990	-8,014	-7,941	-9,257
60%	-8,076	-9,256	-8,969	-8,848	-7,346	-5,373	-6,549	-5,517	-5,660	-8,914	-9,236	-9,889
70%	-9,075	-9,598	-9,326	-9,269	-8,323	-6,205	-7,131	-6,008	-6,016	-9,492	-10,081	-9,977
80%	-9,905	-9,959	-9,508	-9,585	-8,873	-6,616	-7,635	-6,451	-6,534	-10,052	-10,364	-10,089
90%	-10,146	-10,023	-9,665	-9,803	-9,509	-7,592	-7,991	-7,302	-6,936	-10,637	-10,683	-10,163
Long Term												
Full Simulation Period ^b	-6,980	-7,844	-7,429	-6,650	-5,206	-3,727	-5,381	-4,842	-4,611	-7,538	-7,489	-7,917
Water Year Types^c												
Wet (32%)	-8,038	-9,112	-7,723	-4,985	-3,160	-1,004	-6,895	-6,376	-4,024	-8,414	-9,609	-9,678
Above Normal (16%)	-6,419	-7,887	-7,960	-8,266	-6,089	-5,331	-7,034	-5,761	-6,024	-8,921	-9,947	-9,886
Below Normal (13%)	-8,051	-8,891	-8,088	-8,590	-5,749	-5,501	-5,370	-4,954	-6,578	-10,111	-8,035	-8,118
Dry (24%)	-6,466	-7,140	-7,171	-7,358	-6,832	-5,646	-4,159	-3,813	-4,591	-6,827	-5,191	-6,639
Critical (15%)	-5,171	-5,266	-6,040	-5,551	-5,474	-3,067	-2,358	-2,134	-2,583	-2,973	-3,561	-3,911

No Action Alternative

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-3,764	-3,724	-3,812	-2,823	-666	-969	3,205	2,797	-1,150	-4,130	-2,453	-3,775
20%	-4,076	-4,560	-4,673	-2,823	-1,771	-1,394	2,207	1,304	-1,570	-6,849	-4,032	-5,147
30%	-4,613	-5,156	-5,244	-3,355	-2,823	-2,738	1,632	561	-3,500	-7,647	-5,770	-6,006
40%	-4,820	-5,627	-5,871	-4,392	-3,314	-3,500	1,268	108	-3,500	-8,888	-7,996	-7,621
50%	-5,328	-6,320	-5,871	-4,710	-3,781	-3,500	612	-182	-3,500	-9,376	-9,956	-9,000
60%	-5,589	-6,564	-5,871	-5,000	-4,878	-4,568	-102	-483	-4,487	-9,746	-10,630	-9,256
70%	-6,253	-7,101	-7,413	-5,000	-5,000	-5,000	-448	-632	-5,000	-10,301	-10,737	-9,653
80%	-6,560	-8,185	-9,537	-5,000	-5,000	-5,000	-995	-1,129	-5,000	-10,602	-10,853	-9,884
90%	-7,404	-9,995	-9,681	-5,000	-5,000	-5,000	-1,247	-1,414	-5,000	-11,108	-11,083	-10,032
Long Term												
Full Simulation Period ^b	-5,476	-6,380	-6,228	-3,535	-2,905	-2,690	919	310	-3,577	-8,496	-7,975	-7,706
Water Year Types^c												
Wet (32%)	-5,847	-7,229	-5,526	-1,900	-1,991	-1,552	3,110	2,011	-4,274	-8,957	-10,532	-9,358
Above Normal (16%)	-5,525	-6,801	-6,850	-3,699	-3,161	-4,176	1,196	412	-4,525	-9,151	-10,873	-9,542
Below Normal (13%)	-5,488	-6,749	-7,669	-4,380	-3,477	-3,919	165	-316	-3,445	-10,539	-9,624	-8,178
Dry (24%)	-5,440	-5,953	-6,676	-4,621	-3,573	-3,072	-670	-906	-3,350	-8,900	-4,745	-6,453
Critical (15%)	-4,671	-4,458	-5,006	-4,314	-2,968	-1,780	-786	-887	-1,539	-4,242	-3,168	-3,793

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-373	569	298	-241	575	-850	5,257	4,408	1,033	-675	426	-109
20%	3	873	1,370	2,015	1,094	-107	5,338	4,202	1,264	-1,697	599	-39
30%	156	1,838	1,673	2,924	1,545	554	5,589	4,738	-192	-1,159	67	387
40%	1,588	1,993	1,683	3,042	2,492	512	6,090	4,781	758	-1,733	-1,120	644
50%	1,975	2,366	2,302	3,548	2,641	1,458	6,475	5,018	1,490	-1,362	-2,016	257
60%	2,487	2,692	3,098	3,848	2,467	806	6,447	5,034	1,173	-831	-1,394	433
70%	2,822	2,497	1,913	4,269	3,323	1,205	6,682	5,376	1,016	-809	-656	325
80%	3,345	1,773	-29	4,585	3,873	1,616	6,640	5,322	1,534	-550	-489	205
90%	2,742	28	-16	4,803	4,509	2,592	6,744	5,887	1,936	-471	-400	132
Long Term												
Full Simulation Period ^b	1,504	1,464	1,201	3,115	2,301	1,037	6,300	5,152	1,034	-958	-486	211
Water Year Types^c												
Wet (32%)	2,191	1,882	2,198	3,084	1,169	-549	10,005	8,387	-250	-543	-923	320
Above Normal (16%)	895	1,086	1,110	4,566	2,928	1,155	8,229	6,173	1,499	-230	-926	344
Below Normal (13%)	2,563	2,142	419	4,210	2,273	1,582	5,535	4,638	3,133	-429	-1,589	-59
Dry (24%)	1,026	1,187	495	2,737	3,259	2,574	3,489	2,907	1,241	-2,073	446	186
Critical (15%)	500	809	1,034	1,237	2,505	1,287	1,572	1,247	1,044	-1,268	394	118

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.13.3 Old and Middle River, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-3,392	-4,293	-4,109	-2,581	-1,241	-119	-2,051	-1,611	-2,184	-3,454	-2,880	-3,666
20%	-4,079	-5,433	-6,043	-4,838	-2,865	-1,287	-3,131	-2,897	-2,834	-5,152	-4,631	-5,107
30%	-4,769	-6,994	-6,917	-6,279	-4,367	-3,292	-3,957	-4,177	-3,308	-6,488	-5,837	-6,393
40%	-6,409	-7,620	-7,554	-7,434	-5,806	-4,012	-4,821	-4,673	-4,258	-7,155	-6,876	-8,264
50%	-7,303	-8,686	-8,173	-8,257	-6,422	-4,958	-5,864	-5,200	-4,990	-8,014	-7,941	-9,257
60%	-8,076	-9,256	-8,969	-8,848	-7,346	-5,373	-6,549	-5,517	-5,660	-8,914	-9,236	-9,889
70%	-9,075	-9,598	-9,326	-9,269	-8,323	-6,205	-7,131	-6,008	-6,016	-9,492	-10,081	-9,977
80%	-9,905	-9,959	-9,508	-9,585	-8,873	-6,616	-7,635	-6,451	-6,534	-10,052	-10,364	-10,089
90%	-10,146	-10,023	-9,665	-9,803	-9,509	-7,592	-7,991	-7,302	-6,936	-10,637	-10,683	-10,163
Long Term												
Full Simulation Period ^b	-6,980	-7,844	-7,429	-6,650	-5,206	-3,727	-5,381	-4,842	-4,611	-7,538	-7,489	-7,917
Water Year Types^c												
Wet (32%)	-8,038	-9,112	-7,723	-4,985	-3,160	-1,004	-6,895	-6,376	-4,024	-8,414	-9,609	-9,678
Above Normal (16%)	-6,419	-7,887	-7,960	-8,266	-6,089	-5,331	-7,034	-5,761	-6,024	-8,921	-9,947	-9,886
Below Normal (13%)	-8,051	-8,891	-8,088	-8,590	-5,749	-5,501	-5,370	-4,954	-6,578	-10,111	-8,035	-8,118
Dry (24%)	-6,466	-7,140	-7,171	-7,358	-6,832	-5,646	-4,159	-3,813	-4,591	-6,827	-5,191	-6,639
Critical (15%)	-5,171	-5,266	-6,040	-5,551	-5,474	-3,067	-2,358	-2,134	-2,583	-2,973	-3,561	-3,911

Alternative 3

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-3,471	-4,154	-3,935	-2,361	-447	-819	405	-673	-2,098	-3,660	-3,007	-3,495
20%	-4,101	-5,233	-5,184	-3,500	-1,896	-1,347	-946	-1,150	-4,287	-5,775	-4,278	-5,225
30%	-4,803	-6,947	-6,403	-3,500	-2,838	-2,283	-1,200	-1,150	-4,625	-7,093	-6,258	-6,437
40%	-5,638	-7,541	-6,403	-3,500	-3,500	-3,500	-2,086	-2,560	-5,017	-8,012	-7,669	-8,402
50%	-7,049	-8,326	-6,403	-5,000	-3,500	-3,500	-2,787	-3,326	-5,526	-8,990	-9,396	-9,192
60%	-8,252	-9,400	-6,811	-5,000	-4,273	-3,616	-3,368	-3,500	-5,750	-9,549	-9,845	-9,680
70%	-8,982	-9,810	-7,677	-5,000	-5,000	-5,061	-3,526	-3,500	-5,750	-10,046	-10,212	-9,842
80%	-9,734	-9,990	-8,823	-5,000	-5,621	-6,252	-4,031	-4,451	-6,160	-10,767	-10,624	-10,044
90%	-10,085	-10,084	-9,552	-6,976	-7,500	-7,499	-4,474	-5,149	-7,011	-11,148	-10,797	-10,177
Long Term												
Full Simulation Period ^b	-6,888	-7,771	-6,494	-3,764	-3,283	-3,072	-2,176	-2,623	-4,997	-8,112	-7,831	-7,917
Water Year Types^c												
Wet (32%)	-7,965	-9,052	-5,964	-2,522	-2,581	-1,646	-1,367	-2,399	-5,476	-8,581	-9,731	-9,555
Above Normal (16%)	-6,452	-8,078	-6,997	-3,789	-4,137	-5,220	-3,630	-4,226	-5,981	-9,160	-10,444	-9,839
Below Normal (13%)	-7,685	-8,790	-7,868	-4,451	-3,689	-4,765	-2,676	-2,885	-5,409	-10,929	-10,032	-8,880
Dry (24%)	-6,546	-7,086	-6,848	-4,588	-3,582	-3,358	-2,517	-2,670	-4,927	-8,172	-5,079	-6,457
Critical (15%)	-4,869	-4,871	-5,252	-4,429	-3,011	-1,804	-1,328	-1,054	-2,628	-3,280	-3,450	-3,839

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-79	139	175	220	794	-701	2,456	938	85	-205	-127	172
20%	-22	200	858	1,338	969	-61	2,185	1,747	-1,453	-623	353	-118
30%	-34	47	514	2,779	1,529	1,009	2,757	3,027	-1,317	-605	-421	-43
40%	771	79	1,151	3,934	2,306	512	2,735	2,112	-759	-857	-793	-137
50%	254	360	1,769	3,257	2,922	1,458	3,077	1,874	-536	-976	-1,455	64
60%	-177	-144	2,158	3,848	3,072	1,757	3,181	2,017	-90	-635	-609	10
70%	93	-213	1,648	4,269	3,323	1,144	3,605	2,508	266	-553	-131	136
80%	171	-31	685	4,585	3,252	365	3,604	1,999	375	-715	-259	45
90%	61	-61	112	2,827	2,009	93	3,517	2,153	-75	-511	-114	-14
Long Term												
Full Simulation Period ^b	92	73	934	2,886	1,923	656	3,205	2,219	-386	-574	-342	0
Water Year Types^c												
Wet (32%)	73	60	1,759	2,463	579	-642	5,528	3,977	-1,453	-167	-123	124
Above Normal (16%)	-32	-191	963	4,477	1,952	111	3,403	1,535	43	-240	-497	48
Below Normal (13%)	366	101	220	4,139	2,061	736	2,695	2,069	1,169	-818	-1,997	-762
Dry (24%)	-80	54	323	2,770	3,249	2,288	1,642	1,144	-336	-1,345	112	182
Critical (15%)	302	395	789	1,123	2,462	1,263	1,030	1,081	-45	-307	112	73

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.13.4 Old and Middle River, Monthly Flow

Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-3,392	-4,293	-4,109	-2,581	-1,241	-119	-2,051	-1,611	-2,184	-3,454	-2,880	-3,666
20%	-4,079	-5,433	-6,043	-4,838	-2,865	-1,287	-3,131	-2,897	-2,834	-5,152	-4,631	-5,107
30%	-4,769	-6,994	-6,917	-6,279	-4,367	-3,292	-3,957	-4,177	-3,308	-6,488	-5,837	-6,393
40%	-6,409	-7,620	-7,554	-7,434	-5,806	-4,012	-4,821	-4,673	-4,258	-7,155	-6,876	-8,264
50%	-7,303	-8,686	-8,173	-8,257	-6,422	-4,958	-5,864	-5,200	-4,990	-8,014	-7,941	-9,257
60%	-8,076	-9,256	-8,969	-8,848	-7,346	-5,373	-6,549	-5,517	-5,660	-8,914	-9,236	-9,689
70%	-9,075	-9,598	-9,326	-9,269	-8,323	-6,205	-7,131	-6,008	-6,016	-9,492	-10,081	-9,977
80%	-9,905	-9,959	-9,508	-9,585	-8,873	-6,616	-7,635	-6,451	-6,534	-10,052	-10,364	-10,089
90%	-10,146	-10,023	-9,665	-9,803	-9,509	-7,592	-7,991	-7,302	-6,936	-10,637	-10,683	-10,163
Long Term												
Full Simulation Period ^b	-6,980	-7,844	-7,429	-6,650	-5,206	-3,727	-5,381	-4,842	-4,611	-7,538	-7,489	-7,917
Water Year Types^c												
Wet (32%)	-8,038	-9,112	-7,723	-4,985	-3,160	-1,004	-6,895	-6,376	-4,024	-8,414	-9,609	-9,678
Above Normal (16%)	-6,419	-7,887	-7,960	-8,266	-6,089	-5,331	-7,034	-5,761	-6,024	-8,921	-9,947	-9,886
Below Normal (13%)	-8,051	-8,891	-8,088	-8,590	-5,749	-5,501	-5,370	-4,954	-6,578	-10,111	-8,035	-8,118
Dry (24%)	-6,466	-7,140	-7,171	-7,358	-6,832	-5,646	-4,159	-3,813	-4,591	-6,827	-5,191	-6,639
Critical (15%)	-5,171	-5,266	-6,040	-5,551	-5,474	-3,067	-2,358	-2,134	-2,583	-2,973	-3,561	-3,911

Alternative 5

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-3,722	-3,722	-3,826	-2,823	-641	-965	3,206	2,797	-1,150	-4,455	-3,295	-3,913
20%	-4,102	-4,558	-4,737	-2,823	-1,771	-1,394	2,134	1,335	-2,319	-6,620	-4,451	-5,247
30%	-4,583	-5,162	-5,150	-3,355	-2,820	-2,738	1,566	712	-3,500	-8,001	-6,361	-6,304
40%	-4,858	-5,603	-5,871	-4,378	-3,267	-3,500	1,270	568	-3,500	-9,172	-8,612	-7,552
50%	-5,145	-6,098	-5,871	-4,710	-3,513	-3,500	623	381	-3,500	-9,522	-10,244	-8,864
60%	-5,368	-6,494	-5,871	-5,000	-4,878	-4,568	381	381	-4,467	-9,822	-10,615	-9,232
70%	-6,237	-7,087	-7,453	-5,000	-5,000	-5,000	381	381	-5,000	-10,430	-10,756	-9,654
80%	-6,583	-8,086	-9,466	-5,000	-5,000	-5,000	381	381	-5,000	-10,694	-10,844	-9,915
90%	-7,355	-9,871	-9,681	-5,000	-5,000	-5,000	381	381	-5,000	-11,168	-11,076	-10,031
Long Term												
Full Simulation Period ^b	-5,443	-6,337	-6,246	-3,551	-2,904	-2,710	1,482	1,034	-3,631	-8,687	-8,239	-7,714
Water Year Types^c												
Wet (32%)	-5,812	-7,354	-5,572	-1,900	-1,926	-1,598	3,122	2,182	-4,275	-8,965	-10,573	-9,193
Above Normal (16%)	-5,543	-6,368	-6,838	-3,716	-3,222	-4,174	1,292	780	-4,521	-9,187	-10,817	-9,491
Below Normal (13%)	-5,418	-6,748	-7,637	-4,380	-3,554	-3,971	718	468	-3,444	-10,623	-9,770	-8,460
Dry (24%)	-5,380	-5,893	-6,731	-4,620	-3,578	-3,074	565	453	-3,523	-9,446	-5,313	-6,571
Critical (15%)	-4,661	-4,461	-4,983	-4,409	-2,957	-1,770	363	310	-1,623	-4,501	-3,860	-3,805

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-331	571	284	-241	600	-846	5,257	4,408	1,033	-1,001	-415	-247
20%	-23	875	1,306	2,015	1,094	-107	5,265	4,233	516	-1,468	180	-140
30%	186	1,832	1,767	2,924	1,548	554	5,522	4,889	-192	-1,514	-524	89
40%	1,551	2,016	1,683	3,056	2,539	512	6,091	5,240	758	-2,017	-1,736	712
50%	2,158	2,588	2,302	3,548	2,909	1,458	6,487	5,582	1,490	-1,507	-2,303	393
60%	2,707	2,762	3,098	3,848	2,467	806	6,930	5,899	1,193	-907	-1,378	458
70%	2,838	2,511	1,873	4,269	3,323	1,205	7,512	6,390	1,016	-937	-675	323
80%	3,322	1,872	42	4,585	3,873	1,616	8,016	6,832	1,534	-642	-479	174
90%	2,791	152	-16	4,803	4,509	2,592	8,372	7,683	1,936	-531	-393	132
Long Term												
Full Simulation Period ^b	1,537	1,508	1,182	3,099	2,302	1,017	6,863	5,876	980	-1,149	-750	203
Water Year Types^c												
Wet (32%)	2,226	1,758	2,151	3,084	1,234	-595	10,017	8,558	-251	-552	-964	485
Above Normal (16%)	876	1,519	1,122	4,550	2,867	1,158	8,325	6,541	1,503	-266	-871	395
Below Normal (13%)	2,633	2,144	450	4,210	2,196	1,530	6,088	5,422	3,134	-512	-1,735	-342
Dry (24%)	1,086	1,247	439	2,738	3,254	2,573	4,724	4,266	1,068	-2,620	-122	68
Critical (15%)	510	805	1,058	1,142	2,516	1,296	2,721	2,445	961	-1,528	-298	107

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

5C.3.3.14 Exports through Jones and Banks Pumping Plants

Table 5C.3.3.14.1 Exports Through Jones and Banks Pumping Plants, Monthly Export Volume

No Action Alternative

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	517	671	721	604	611	675	242	240	509	714	724	671
20%	454	572	717	490	532	617	181	151	359	708	724	664
30%	434	479	685	427	448	508	158	127	340	694	715	651
40%	400	443	558	419	409	479	138	104	318	667	707	623
50%	370	415	494	406	380	424	128	97	253	634	692	604
60%	336	381	477	396	363	349	121	92	207	588	519	509
70%	310	347	454	377	325	312	113	92	192	501	371	410
80%	286	302	379	321	267	283	104	92	150	444	240	335
90%	250	251	335	280	165	159	89	92	43	232	141	243
Long Term												
Full Simulation Period ^b	378	430	527	426	395	423	154	140	276	558	521	514
Water Year Types^c												
Wet (32%)	410	497	564	513	537	594	204	207	445	669	717	638
Above Normal (16%)	376	450	562	406	401	496	130	105	315	587	709	628
Below Normal (13%)	386	456	590	387	354	394	134	100	209	657	622	542
Dry (24%)	374	398	510	392	315	318	153	126	194	541	296	426
Critical (15%)	314	293	384	349	250	179	93	90	64	223	176	242

Alternative 1

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	694	671	739	803	727	703	526	515	555	694	694	671
20%	680	671	724	769	686	608	503	420	455	694	694	671
30%	627	652	719	747	668	560	477	387	425	680	694	671
40%	553	623	718	741	614	542	427	351	412	624	634	669
50%	489	591	683	730	552	509	390	319	389	551	515	635
60%	433	513	601	635	519	486	321	281	361	474	446	545
70%	318	464	553	565	465	461	258	242	320	404	369	420
80%	273	352	500	499	416	374	188	181	176	300	281	340
90%	209	288	378	391	335	304	109	80	128	160	161	226
Long Term												
Full Simulation Period ^b	471	525	612	638	538	489	351	308	352	494	489	528
Water Year Types^c												
Wet (32%)	549	619	716	724	609	543	476	430	456	632	655	660
Above Normal (16%)	428	521	641	716	584	570	453	363	415	572	647	651
Below Normal (13%)	548	595	623	674	497	500	337	304	414	629	517	539
Dry (24%)	435	475	546	579	518	493	259	228	274	403	325	438
Critical (15%)	340	345	455	433	406	266	134	121	132	139	203	249

Alternative 1 minus No Action Alternative

Statistic	Monthly Export Volume (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	34%	0%	2%	33%	19%	4%	117%	115%	9%	-3%	-4%	0%
20%	50%	17%	1%	57%	29%	-2%	178%	178%	27%	-2%	-4%	1%
30%	44%	36%	5%	75%	49%	10%	202%	203%	25%	-2%	-3%	3%
40%	38%	41%	29%	77%	50%	13%	210%	238%	30%	-6%	-10%	7%
50%	32%	42%	38%	80%	45%	20%	204%	229%	54%	-13%	-26%	5%
60%	29%	34%	26%	60%	43%	39%	166%	204%	74%	-19%	-14%	7%
70%	3%	34%	22%	50%	43%	48%	128%	162%	66%	-20%	-1%	3%
80%	-5%	17%	32%	56%	56%	32%	80%	96%	17%	-33%	17%	1%
90%	-16%	15%	13%	40%	103%	91%	22%	-13%	199%	-31%	14%	-7%
Long Term												
Full Simulation Period ^b	24%	22%	16%	50%	36%	15%	127%	120%	28%	-11%	-6%	3%
Water Year Types^c												
Wet (32%)	34%	25%	27%	41%	13%	-9%	134%	108%	2%	-5%	-9%	3%
Above Normal (16%)	14%	16%	14%	77%	46%	15%	247%	244%	32%	-3%	-9%	4%
Below Normal (13%)	42%	31%	6%	74%	40%	27%	151%	204%	98%	-4%	-17%	-1%
Dry (24%)	16%	19%	7%	48%	64%	55%	69%	81%	41%	-25%	10%	3%
Critical (15%)	8%	18%	19%	24%	62%	49%	44%	34%	104%	-38%	15%	3%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.14.2 Exports Through Jones and Banks Pumping Plants, Monthly Export Volume

Second Basis of Comparison

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	694	671	739	803	727	703	526	515	555	694	694	671
20%	680	671	724	769	686	608	503	420	455	694	694	671
30%	627	652	719	747	668	560	477	387	425	680	694	671
40%	553	623	718	741	614	542	427	351	412	624	634	669
50%	489	591	683	730	552	509	390	319	389	551	515	635
60%	433	513	601	635	519	486	321	281	361	474	446	545
70%	318	464	553	565	465	461	258	242	320	404	369	420
80%	273	352	500	499	416	374	188	181	176	300	281	340
90%	209	288	378	391	335	304	109	80	128	160	161	226
Long Term												
Full Simulation Period ^b	471	525	612	638	538	489	351	308	352	494	489	528
Water Year Types^c												
Wet (32%)	549	619	716	724	609	543	476	430	456	632	655	660
Above Normal (16%)	428	521	641	716	584	570	453	363	415	572	647	651
Below Normal (13%)	548	595	623	674	497	500	337	304	414	629	517	539
Dry (24%)	435	475	546	579	518	493	259	228	274	403	325	438
Critical (15%)	340	345	455	433	406	266	134	121	132	139	203	249

No Action Alternative

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	517	671	721	604	611	675	242	240	509	714	724	671
20%	454	572	717	490	532	617	181	151	359	708	724	664
30%	434	479	685	427	448	508	158	127	340	694	715	651
40%	400	443	558	419	409	479	138	104	318	667	707	623
50%	370	415	494	406	380	424	128	97	253	634	692	604
60%	336	381	477	396	363	349	121	92	207	588	519	509
70%	310	347	454	377	325	312	113	92	192	501	371	410
80%	286	302	379	321	267	283	104	92	150	444	240	335
90%	250	251	335	280	165	159	89	92	43	232	141	243
Long Term												
Full Simulation Period ^b	378	430	527	426	395	423	154	140	276	558	521	514
Water Year Types^c												
Wet (32%)	410	497	564	513	537	594	204	207	445	669	717	638
Above Normal (16%)	376	450	562	406	401	496	130	105	315	587	709	628
Below Normal (13%)	386	456	590	387	354	394	134	100	209	657	622	542
Dry (24%)	374	398	510	392	315	318	153	126	194	541	296	426
Critical (15%)	314	293	384	349	250	179	93	90	64	223	176	242

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Export Volume (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-25%	0%	-2%	-25%	-16%	-4%	-54%	-53%	-8%	3%	4%	0%
20%	-33%	-15%	-1%	-36%	-22%	2%	-64%	-64%	-21%	2%	4%	-1%
30%	-31%	-27%	-5%	-43%	-33%	-9%	-67%	-67%	-20%	2%	3%	-3%
40%	-28%	-29%	-22%	-43%	-33%	-12%	-68%	-70%	-23%	7%	12%	-7%
50%	-24%	-30%	-28%	-44%	-31%	-17%	-67%	-70%	-35%	15%	34%	-5%
60%	-22%	-26%	-21%	-38%	-30%	-28%	-62%	-67%	-43%	24%	16%	-7%
70%	-3%	-25%	-18%	-33%	-30%	-32%	-56%	-62%	-40%	24%	1%	-2%
80%	5%	-14%	-24%	-36%	-36%	-24%	-44%	-49%	-14%	48%	-15%	-1%
90%	19%	-13%	-11%	-29%	-51%	-48%	-18%	15%	-67%	45%	-13%	7%
Long Term												
Full Simulation Period ^b	-20%	-18%	-14%	-33%	-27%	-13%	-56%	-55%	-22%	13%	7%	-3%
Water Year Types^c												
Wet (32%)	-25%	-20%	-21%	-29%	-12%	9%	-57%	-52%	-2%	6%	10%	-3%
Above Normal (16%)	-12%	-14%	-12%	-43%	-31%	-13%	-71%	-71%	-24%	3%	9%	-3%
Below Normal (13%)	-30%	-23%	-5%	-43%	-29%	-21%	-60%	-67%	-50%	4%	20%	1%
Dry (24%)	-14%	-16%	-7%	-32%	-39%	-36%	-41%	-45%	-29%	34%	-9%	-3%
Critical (15%)	-8%	-15%	-16%	-19%	-38%	-33%	-31%	-25%	-51%	60%	-13%	-3%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.14.3 Exports Through Jones and Banks Pumping Plants, Monthly Export Volume

Second Basis of Comparison

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	694	671	739	803	727	703	526	515	555	694	694	671
20%	680	671	724	769	686	608	503	420	455	694	694	671
30%	627	652	719	747	668	560	477	387	425	680	694	671
40%	553	623	718	741	614	542	427	351	412	624	634	669
50%	489	591	683	730	552	509	390	319	389	551	515	635
60%	433	513	601	635	519	486	321	281	361	474	446	545
70%	318	464	553	565	465	461	258	242	320	404	369	420
80%	273	352	500	499	416	374	188	181	176	300	281	340
90%	209	288	378	391	335	304	109	80	128	160	161	226
Long Term												
Full Simulation Period ^b	471	525	612	638	538	489	351	308	352	494	489	528
Water Year Types^c												
Wet (32%)	549	619	716	724	609	543	476	430	456	632	655	660
Above Normal (16%)	428	521	641	716	584	570	453	363	415	572	647	651
Below Normal (13%)	548	595	623	674	497	500	337	304	414	629	517	539
Dry (24%)	435	475	546	579	518	493	259	228	274	403	325	438
Critical (15%)	340	345	455	433	406	266	134	121	132	139	203	249

Alternative 3

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	694	671	718	653	725	722	547	563	667	694	694	671
20%	673	671	691	565	603	622	510	496	461	694	694	671
30%	627	652	628	440	524	577	465	452	399	694	694	671
40%	552	627	583	422	449	532	437	386	373	680	694	657
50%	476	571	546	411	393	460	369	329	355	628	624	640
60%	382	501	523	395	365	351	320	281	338	566	502	572
70%	322	467	505	377	320	316	255	230	311	448	396	417
80%	265	346	479	328	264	288	187	124	252	382	268	344
90%	218	276	378	304	202	159	124	102	138	190	170	228
Long Term												
Full Simulation Period ^b	465	520	549	442	426	445	353	330	362	533	513	529
Water Year Types^c												
Wet (32%)	544	615	601	559	594	589	494	490	519	648	667	654
Above Normal (16%)	430	533	574	414	469	566	441	413	397	586	680	647
Below Normal (13%)	524	587	607	394	373	448	312	266	330	683	650	588
Dry (24%)	440	471	523	389	314	337	270	242	292	492	318	426
Critical (15%)	321	319	401	355	251	180	127	100	131	158	196	245

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Export Volume (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	-3%	-19%	0%	3%	4%	9%	20%	0%	0%	0%
20%	-1%	0%	-5%	-27%	-12%	2%	1%	18%	1%	0%	0%	0%
30%	0%	0%	-13%	-41%	-21%	3%	-3%	17%	-6%	2%	0%	0%
40%	0%	1%	-19%	-43%	-27%	-2%	2%	10%	-9%	9%	9%	-2%
50%	-3%	-3%	-20%	-44%	-29%	-10%	-5%	3%	-9%	14%	21%	1%
60%	-12%	-2%	-13%	-38%	-30%	-28%	0%	0%	-6%	19%	13%	5%
70%	1%	0%	-9%	-33%	-31%	-31%	-1%	-5%	-3%	11%	7%	-1%
80%	-3%	-2%	-4%	-34%	-37%	-23%	0%	-31%	43%	27%	-5%	1%
90%	4%	-4%	0%	-22%	-40%	-48%	14%	26%	8%	19%	5%	1%
Long Term												
Full Simulation Period ^b	-1%	-1%	-10%	-31%	-21%	-9%	1%	7%	3%	8%	5%	0%
Water Year Types^c												
Wet (32%)	-1%	-1%	-16%	-23%	-2%	9%	4%	14%	14%	3%	2%	-1%
Above Normal (16%)	0%	2%	-10%	-42%	-20%	-1%	-3%	14%	-4%	2%	5%	-1%
Below Normal (13%)	-4%	-1%	-3%	-42%	-25%	-10%	-7%	-12%	-20%	9%	26%	9%
Dry (24%)	1%	-1%	-4%	-33%	-39%	-32%	4%	6%	6%	22%	-2%	-3%
Critical (15%)	-6%	-7%	-12%	-18%	-38%	-32%	-5%	-17%	0%	14%	-3%	-2%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.14.4 Exports Through Jones and Banks Pumping Plants, Monthly Export Volume

Second Basis of Comparison

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	694	671	739	803	727	703	526	515	555	694	694	671
20%	680	671	724	769	686	608	503	420	455	694	694	671
30%	627	652	719	747	668	560	477	387	425	680	694	671
40%	553	623	718	741	614	542	427	351	412	624	634	669
50%	489	591	683	730	552	509	390	319	389	551	515	635
60%	433	513	601	635	519	486	321	281	361	474	446	545
70%	318	464	553	565	465	461	258	242	320	404	369	420
80%	273	352	500	499	416	374	188	181	176	300	281	340
90%	209	288	378	391	335	304	109	80	128	160	161	226
Long Term												
Full Simulation Period ^b	471	525	612	638	538	489	351	308	352	494	489	528
Water Year Types^c												
Wet (32%)	549	619	716	724	609	543	476	430	456	632	655	660
Above Normal (16%)	428	521	641	716	584	570	453	363	415	572	647	651
Below Normal (13%)	548	595	623	674	497	500	337	304	414	629	517	539
Dry (24%)	435	475	546	579	518	493	259	228	274	403	325	438
Critical (15%)	340	345	455	433	406	266	134	121	132	139	203	249

Alternative 5

Statistic	Monthly Export Volume (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	514	671	721	604	613	677	223	218	509	714	724	671
20%	454	553	717	490	528	612	165	127	359	709	724	662
30%	429	479	685	427	448	528	134	91	340	696	715	648
40%	378	443	558	419	416	479	122	83	318	678	705	626
50%	360	408	496	405	380	424	111	71	251	646	693	598
60%	334	375	481	396	363	349	97	50	207	606	571	508
70%	311	347	452	377	323	312	80	38	193	568	401	415
80%	289	302	387	319	267	283	45	23	178	445	278	347
90%	245	250	337	280	165	159	30	7	42	271	192	254
Long Term												
Full Simulation Period ^b	376	427	528	427	394	423	122	99	279	570	538	514
Water Year Types^c												
Wet (32%)	408	505	564	514	532	592	202	202	444	667	718	627
Above Normal (16%)	376	423	561	407	405	496	127	92	315	590	705	625
Below Normal (13%)	381	456	588	387	359	397	103	55	208	663	632	561
Dry (24%)	370	394	513	392	315	318	80	41	205	577	333	433
Critical (15%)	313	293	382	355	249	179	34	20	69	239	222	243

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Export Volume (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-26%	0%	-2%	-25%	-16%	-4%	-58%	-58%	-8%	3%	4%	0%
20%	-33%	-18%	-1%	-36%	-23%	1%	-67%	-70%	-21%	2%	4%	-1%
30%	-32%	-26%	-5%	-43%	-33%	-6%	-72%	-77%	-20%	2%	3%	-4%
40%	-32%	-29%	-22%	-43%	-32%	-12%	-71%	-77%	-23%	9%	11%	-6%
50%	-26%	-31%	-27%	-45%	-31%	-17%	-71%	-78%	-35%	17%	35%	-6%
60%	-23%	-27%	-20%	-38%	-30%	-28%	-70%	-82%	-43%	28%	28%	-7%
70%	-2%	-25%	-18%	-33%	-30%	-32%	-69%	-84%	-40%	41%	9%	-1%
80%	6%	-14%	-23%	-36%	-36%	-24%	-76%	-87%	1%	49%	-1%	2%
90%	17%	-13%	-11%	-29%	-51%	-48%	-72%	-91%	-67%	69%	19%	12%
Long Term												
Full Simulation Period ^b	-20%	-19%	-14%	-33%	-27%	-13%	-65%	-68%	-21%	15%	10%	-3%
Water Year Types^c												
Wet (32%)	-26%	-19%	-21%	-29%	-13%	9%	-58%	-53%	-3%	6%	10%	-5%
Above Normal (16%)	-12%	-19%	-12%	-43%	-31%	-13%	-72%	-75%	-24%	3%	9%	-4%
Below Normal (13%)	-30%	-23%	-6%	-43%	-28%	-21%	-69%	-82%	-50%	5%	22%	4%
Dry (24%)	-15%	-17%	-6%	-32%	-39%	-36%	-69%	-82%	-25%	43%	2%	-1%
Critical (15%)	-8%	-15%	-16%	-18%	-39%	-33%	-75%	-83%	-48%	72%	10%	-2%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

5C.3.3.15 CVP Deliveries

Table 5C.3.3.15.1.1 CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP

				Alternative 1	No Action Alternative	Alternative 1 minus No Action Alternative
Water Supply Reliability						
Sacramento River Hydrologic Region						
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term	1,858	1,859	-1
			Dry	1,905	1,906	0
			Critical	1,734	1,737	-3
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	155	146	8
			Dry	151	146	6
			Critical	105	102	3
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	214	207	7
			Dry	192	186	6
			Critical	152	152	0
CVP Ag	Contract Delivery (annual average - does not include Settlement contractors)	(TAF/year)	Long Term	221	185	36
			Dry	124	86	39
			Critical	38	24	14
San Joaquin River Hydrologic Region (not including Friant-Kern and Madera Canal water users and Eastside Contractors deliveries)						
CVP Exchange	Contract Delivery (annual average)	(TAF/year)	Long Term	852	852	0
			Dry	875	875	0
			Critical	741	741	0
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	261	261	0
			Dry	268	269	0
			Critical	224	224	0
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	0	0	0
			Dry	0	0	0
			Critical	0	0	0
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	350	269	82
			Dry	206	140	67
			Critical	65	41	24
San Francisco Bay Hydrologic Region						
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	289	275	13
			Dry	284	274	10
			Critical	270	264	6
CVP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	43	33	11
			Dry	25	17	8
			Critical	8	5	3
Central Coast Hydrologic Region						
Tulare Lake Hydrologic Region (not including Friant-Kern Canal water users)						
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	12	12	0
			Dry	12	12	0
			Critical	10	10	0
CVP Ag	Contract Delivery (annual average - includes Cross Valley Canal)	(TAF/year)	Long Term	715	545	169
			Dry	430	288	143
			Critical	137	85	51
Total For All Regions						
Total Supplies	Contract Delivery (annual average)	(TAF/year)	Long Term	4,971	4,646	325
			Dry	4,475	4,198	277
			Critical	3,484	3,385	99

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text.

Table 5C.3.3.15.1.2 CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP

				Alternative 1	No Action Alternative	Alternative 1 minus No Action Alternative
Water Supply Reliability						
North of Delta						
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	221	185	36
			Dry	124	86	39
			Critical	38	24	14
CVP M&I (Including American River)	Contract Delivery (annual average)	(TAF/year)	Long Term	486	467	19
			Dry	461	447	14
			Critical	410	405	5
CVP M&I American River	Contract Delivery (annual average)	(TAF/year)	Long Term	120	113	8
			Dry	105	97	9
			Critical	80	75	6
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term	1,858	1,859	-1
			Dry	1,905	1,906	0
			Critical	1,734	1,737	-3
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	155	146	8
			Dry	151	146	6
			Critical	105	102	3
Total CVP North of Delta						
Total CVP Ag, M&I, Settlement, and Refuge Deliveries	Contract Delivery (CVP) (annual average)	(TAF/year)	Long Term	2,720	2,658	62
			Dry	2,642	2,584	58
			Critical	2,287	2,268	19
South of Delta (Does not include Eastside Contractors deliveries)						
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	1,108	847	262
			Dry	662	445	218
			Critical	210	131	78
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	17	15	2
			Dry	15	14	1
			Critical	12	11	1
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	261	261	0
			Dry	268	269	0
			Critical	224	224	0
Total CVP South of Delta (Does not include Eastside Contractors deliveries)						
Total CVP Ag, M&I, Settlement, and Refuge Deliveries	Contract Delivery (annual average)	(TAF/year)	Long Term	1,386	1,123	263
			Dry	946	727	219
			Critical	445	366	79
Eastside Contractors deliveries						
Water Rights	Delivery (annual average)	(TAF/year)	Long Term	510	508	2
			Dry	524	524	0
			Critical	460	445	16
CVP Service Contracts	Contract Delivery (annual average)	(TAF/year)	Long Term	108	104	5
			Dry	87	84	2
			Critical	4	4	0
Total Eastside Contractors Deliveries						
Total Water Rights and CVP Service Contracts Deliveries	Delivery (annual average)	(TAF/year)	Long Term	618	611	7
			Dry	611	608	2
			Critical	465	449	16

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 6) Contra Costa Water District accounted for as part of North of Delta deliveries.

Table 5C.3.3.15.2.1 CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP

				No Action Alternative	Second Basis of Comparison	No Action Alternative minus Second Basis of Comparison
Water Supply Reliability						
Sacramento River Hydrologic Region						
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term	1,859	1,858	1
			Dry	1,906	1,905	0
			Critical	1,737	1,734	3
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	146	155	-8
			Dry	146	151	-6
			Critical	102	105	-3
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	207	214	-7
			Dry	186	192	-6
			Critical	152	152	0
CVP Ag	Contract Delivery (annual average - does not include Settlement contractors)	(TAF/year)	Long Term	185	221	-36
			Dry	86	124	-39
			Critical	24	38	-14
San Joaquin River Hydrologic Region (not including Friant-Kern and Madera Canal water users and Eastside Contractors deliveries)						
CVP Exchange	Contract Delivery (annual average)	(TAF/year)	Long Term	852	852	0
			Dry	875	875	0
			Critical	741	741	0
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	261	261	0
			Dry	269	268	0
			Critical	224	224	0
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	0	0	0
			Dry	0	0	0
			Critical	0	0	0
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	269	350	-82
			Dry	140	206	-67
			Critical	41	65	-24
San Francisco Bay Hydrologic Region						
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	275	289	-13
			Dry	274	284	-10
			Critical	264	270	-6
CVP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	33	43	-11
			Dry	17	25	-8
			Critical	5	8	-3
Central Coast Hydrologic Region						
Tulare Lake Hydrologic Region (not including Friant-Kern Canal water users)						
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	12	12	0
			Dry	12	12	0
			Critical	10	10	0
CVP Ag	Contract Delivery (annual average - includes Cross Valley Canal)	(TAF/year)	Long Term	545	715	-169
			Dry	288	430	-143
			Critical	85	137	-51
Total For All Regions						
Total Supplies	Contract Delivery (annual average)	(TAF/year)	Long Term	4,646	4,971	-325
			Dry	4,198	4,475	-277
			Critical	3,385	3,484	-99

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text.

Table 5C.3.3.15.2.2 CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP

				No Action Alternative	Second Basis of Comparison	No Action Alternative minus Second Basis of Comparison
Water Supply Reliability						
North of Delta						
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	185	221	-36
			Dry	86	124	-39
			Critical	24	38	-14
CVP M&I (Including American River)	Contract Delivery (annual average)	(TAF/year)	Long Term	467	486	-19
			Dry	447	461	-14
			Critical	405	410	-5
CVP M&I American River	Contract Delivery (annual average)	(TAF/year)	Long Term	113	120	-8
			Dry	97	105	-9
			Critical	75	80	-6
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term	1,859	1,858	1
			Dry	1,906	1,905	0
			Critical	1,737	1,734	3
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	146	155	-8
			Dry	146	151	-6
			Critical	102	105	-3
Total CVP North of Delta						
Total CVP Ag, M&I, Settlement, and Refuge Deliveries	Contract Delivery (CVP) (annual average)	(TAF/year)	Long Term	2,658	2,720	-62
			Dry	2,584	2,642	-58
			Critical	2,268	2,287	-19
South of Delta (Does not include Eastside Contractors deliveries)						
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	847	1,108	-262
			Dry	445	662	-218
			Critical	131	210	-78
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	15	17	-2
			Dry	14	15	-1
			Critical	11	12	-1
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	261	261	0
			Dry	269	268	0
			Critical	224	224	0
Total CVP South of Delta (Does not include Eastside Contractors deliveries)						
Total CVP Ag, M&I, Settlement, and Refuge Deliveries	Contract Delivery (annual average)	(TAF/year)	Long Term	1,123	1,386	-263
			Dry	727	946	-219
			Critical	366	445	-79
Eastside Contractors deliveries						
Water Rights	Delivery (annual average)	(TAF/year)	Long Term	508	510	-2
			Dry	524	524	0
			Critical	445	460	-16
CVP Service Contracts	Contract Delivery (annual average)	(TAF/year)	Long Term	104	108	-5
			Dry	84	87	-2
			Critical	4	4	0
Total Eastside Contractors Deliveries						
Total Water Rights and CVP Service Contracts Deliveries	Delivery (annual average)	(TAF/year)	Long Term	611	618	-7
			Dry	608	611	-2
			Critical	449	465	-16

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 6) Contra Costa Water District accounted for as part of North of Delta deliveries.

Table 5C.3.3.15.3.1 CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP

				Alternative 3	Second Basis of Comparison	Alternative 3 minus Second Basis of Comparison
Water Supply Reliability						
Sacramento River Hydrologic Region						
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term	1,860	1,858	2
			Dry	1,906	1,905	0
			Critical	1,742	1,734	8
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	153	155	-1
			Dry	149	151	-2
			Critical	103	105	-2
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	214	214	-1
			Dry	192	192	0
			Critical	152	152	1
CVP Ag	Contract Delivery (annual average - does not include Settlement contractors)	(TAF/year)	Long Term	209	221	-12
			Dry	111	124	-13
			Critical	31	38	-7
San Joaquin River Hydrologic Region (not including Friant-Kern and Madera Canal water users and Eastside Contractors deliveries)						
CVP Exchange	Contract Delivery (annual average)	(TAF/year)	Long Term	852	852	0
			Dry	875	875	0
			Critical	741	741	0
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	261	261	0
			Dry	269	268	0
			Critical	224	224	0
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	0	0	0
			Dry	0	0	0
			Critical	0	0	0
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	342	350	-9
			Dry	185	206	-21
			Critical	53	65	-12
San Francisco Bay Hydrologic Region						
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	286	289	-3
			Dry	283	284	-1
			Critical	267	270	-4
CVP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	42	43	-1
			Dry	23	25	-2
			Critical	6	8	-2
Central Coast Hydrologic Region						
Tulare Lake Hydrologic Region (not including Friant-Kern Canal water users)						
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	12	12	0
			Dry	12	12	0
			Critical	10	10	0
CVP Ag	Contract Delivery (annual average - includes Cross Valley Canal)	(TAF/year)	Long Term	696	715	-19
			Dry	387	430	-43
			Critical	108	137	-28
Total For All Regions						
Total Supplies	Contract Delivery (annual average)	(TAF/year)	Long Term	4,927	4,971	-44
			Dry	4,392	4,475	-82
			Critical	3,437	3,484	-46

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text.

Table 5C.3.3.15.3.2 CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP

				Alternative 3	Second Basis of Comparison	Alternative 3 minus Second Basis of Comparison
Water Supply Reliability						
North of Delta						
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	209	221	-12
			Dry	111	124	-13
			Critical	31	38	-7
CVP M&I (Including American River)	Contract Delivery (annual average)	(TAF/year)	Long Term	483	486	-3
			Dry	460	461	-1
			Critical	408	410	-3
CVP M&I American River	Contract Delivery (annual average)	(TAF/year)	Long Term	118	120	-2
			Dry	104	105	-2
			Critical	78	80	-3
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term	1,860	1,858	2
			Dry	1,906	1,905	0
			Critical	1,742	1,734	8
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	153	155	-1
			Dry	149	151	-2
			Critical	103	105	-2
Total CVP North of Delta						
Total CVP Ag, M&I, Settlement, and Refuge Deliveries	Contract Delivery (CVP) (annual average)	(TAF/year)	Long Term	2,706	2,720	-15
			Dry	2,626	2,642	-16
			Critical	2,284	2,287	-4
South of Delta (Does not include Eastside Contractors deliveries)						
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	1,079	1,108	-29
			Dry	596	662	-67
			Critical	168	210	-42
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	17	17	0
			Dry	15	15	0
			Critical	11	12	0
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	261	261	0
			Dry	269	268	0
			Critical	224	224	0
Total CVP South of Delta (Does not include Eastside Contractors deliveries)						
Total CVP Ag, M&I, Settlement, and Refuge Deliveries	Contract Delivery (annual average)	(TAF/year)	Long Term	1,357	1,386	-29
			Dry	879	946	-66
			Critical	403	445	-43
Eastside Contractors deliveries						
Water Rights	Delivery (annual average)	(TAF/year)	Long Term	513	510	3
			Dry	524	524	0
			Critical	478	460	17
CVP Service Contracts	Contract Delivery (annual average)	(TAF/year)	Long Term	123	108	15
			Dry	109	87	22
			Critical	36	4	32
Total Eastside Contractors Deliveries						
Total Water Rights and CVP Service Contracts Deliveries	Delivery (annual average)	(TAF/year)	Long Term	636	618	18
			Dry	633	611	22
			Critical	514	465	50

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 6) Contra Costa Water District accounted for as part of North of Delta deliveries.

Table 5C.3.3.15.4.1 CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP

				Alternative 5	Second Basis of Comparison	Alternative 5 minus Second Basis of Comparison
Water Supply Reliability						
Sacramento River Hydrologic Region						
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term	1,861	1,858	3
			Dry	1,906	1,905	0
			Critical	1,747	1,734	13
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	146	155	-9
			Dry	145	151	-6
			Critical	103	105	-2
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	207	214	-7
			Dry	186	192	-6
			Critical	152	152	0
CVP Ag	Contract Delivery (annual average - does not include Settlement contractors)	(TAF/year)	Long Term	185	221	-36
			Dry	85	124	-39
			Critical	24	38	-14
San Joaquin River Hydrologic Region (not including Friant-Kern and Madera Canal water users and Eastside Contractors deliveries)						
CVP Exchange	Contract Delivery (annual average)	(TAF/year)	Long Term	852	852	0
			Dry	875	875	0
			Critical	741	741	0
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	261	261	0
			Dry	269	268	0
			Critical	222	224	-2
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	0	0	0
			Dry	0	0	0
			Critical	0	0	0
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	264	350	-87
			Dry	135	206	-71
			Critical	40	65	-25
San Francisco Bay Hydrologic Region						
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	275	289	-13
			Dry	275	284	-9
			Critical	264	270	-6
CVP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	32	43	-11
			Dry	17	25	-8
			Critical	5	8	-3
Central Coast Hydrologic Region						
Tulare Lake Hydrologic Region (not including Friant-Kern Canal water users)						
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	12	12	0
			Dry	12	12	0
			Critical	10	10	0
CVP Ag	Contract Delivery (annual average - includes Cross Valley Canal)	(TAF/year)	Long Term	538	715	-176
			Dry	281	430	-149
			Critical	85	137	-52
Total For All Regions						
Total Supplies	Contract Delivery (annual average)	(TAF/year)	Long Term	4,634	4,971	-337
			Dry	4,186	4,475	-288
			Critical	3,393	3,484	-91

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text.

Table 5C.3.3.15.4.2 CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP

				Alternative 5	Second Basis of Comparison	Alternative 5 minus Second Basis of Comparison
Water Supply Reliability						
North of Delta						
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	185	221	-36
			Dry	85	124	-39
			Critical	24	38	-14
CVP M&I (Including American River)	Contract Delivery (annual average)	(TAF/year)	Long Term	467	486	-18
			Dry	447	461	-13
			Critical	405	410	-5
CVP M&I American River	Contract Delivery (annual average)	(TAF/year)	Long Term	112	120	-8
			Dry	96	105	-9
			Critical	74	80	-7
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term	1,861	1,858	3
			Dry	1,906	1,905	0
			Critical	1,747	1,734	13
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	146	155	-9
			Dry	145	151	-6
			Critical	103	105	-2
Total CVP North of Delta						
Total CVP Ag, M&I, Settlement, and Refuge Deliveries	Contract Delivery (CVP) (annual average)	(TAF/year)	Long Term	2,660	2,720	-60
			Dry	2,584	2,642	-58
			Critical	2,279	2,287	-8
South of Delta (Does not include Eastside Contractors deliveries)						
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	834	1,108	-274
			Dry	433	662	-229
			Critical	130	210	-80
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	15	17	-2
			Dry	14	15	-1
			Critical	11	12	-1
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	261	261	0
			Dry	269	268	0
			Critical	222	224	-2
Total CVP South of Delta (Does not include Eastside Contractors deliveries)						
Total CVP Ag, M&I, Settlement, and Refuge Deliveries	Contract Delivery (annual average)	(TAF/year)	Long Term	1,110	1,386	-276
			Dry	715	946	-230
			Critical	363	445	-83
Eastside Contractors deliveries						
Water Rights	Delivery (annual average)	(TAF/year)	Long Term	502	510	-8
			Dry	524	524	0
			Critical	406	460	-55
CVP Service Contracts	Contract Delivery (annual average)	(TAF/year)	Long Term	100	108	-8
			Dry	69	87	-18
			Critical	8	4	4
Total Eastside Contractors Deliveries						
Total Water Rights and CVP Service Contracts Deliveries	Delivery (annual average)	(TAF/year)	Long Term	602	618	-16
			Dry	593	611	-18
			Critical	414	465	-50

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 6) Contra Costa Water District accounted for as part of North of Delta deliveries.

Table 5C.3.3.15.5 CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP

	Stanislaus Deliveries		Difference from No Action Alternative		Difference from Second Basis of Comparison	
	CVP	Water Rights	CVP	Water Rights	CVP	Water Rights
	(TAF)	(TAF)	(TAF)	(TAF)	(TAF)	(TAF)
No Action Alternative	103.5	507.8				
Second Basis of Comparison	108.1	510.1	4.5	2.3		
Alternative 2	103.5	507.8			-4.5	-2.3
Alternative 3	123.2	512.7	19.6	4.9	15.1	2.6
Alternative 5	99.7	502.1	-3.8	-5.7	-8.4	-8.1

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

5C.3.3.16 CVP Total Generating Capacity

Table 5C.3.3.16.1 CVP Total Capacity, Monthly Capacity

No Action Alternative

Statistic	Monthly Capacity (MW)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,688	1,743	1,810	1,854	1,883	1,895	1,877	1,848	1,785	1,749	1,670	1,647
20%	1,638	1,724	1,772	1,829	1,858	1,872	1,842	1,806	1,719	1,695	1,623	1,615
30%	1,600	1,694	1,744	1,802	1,837	1,842	1,825	1,782	1,671	1,623	1,585	1,599
40%	1,579	1,635	1,710	1,776	1,811	1,812	1,793	1,736	1,634	1,583	1,545	1,553
50%	1,550	1,611	1,681	1,732	1,778	1,782	1,757	1,711	1,607	1,543	1,510	1,516
60%	1,529	1,556	1,622	1,700	1,749	1,752	1,725	1,652	1,564	1,504	1,481	1,473
70%	1,465	1,519	1,588	1,661	1,712	1,714	1,685	1,618	1,524	1,457	1,433	1,432
80%	1,354	1,428	1,521	1,584	1,666	1,675	1,637	1,578	1,440	1,353	1,332	1,342
90%	1,137	1,293	1,403	1,455	1,476	1,502	1,454	1,384	1,203	1,120	1,085	1,103
Long Term												
Full Simulation Period ^b	1,476	1,542	1,612	1,685	1,727	1,734	1,705	1,648	1,542	1,468	1,429	1,430
Water Year Types^c												
Wet (32%)	1,621	1,696	1,761	1,824	1,860	1,877	1,859	1,831	1,753	1,717	1,645	1,628
Above Normal (16%)	1,465	1,580	1,676	1,762	1,814	1,814	1,793	1,741	1,633	1,590	1,545	1,541
Below Normal (13%)	1,530	1,580	1,669	1,719	1,764	1,757	1,728	1,665	1,559	1,491	1,478	1,483
Dry (24%)	1,441	1,491	1,556	1,637	1,690	1,709	1,680	1,607	1,508	1,434	1,418	1,433
Critical (15%)	1,180	1,221	1,264	1,348	1,374	1,355	1,299	1,205	1,025	832	808	825

Alternative 1

Statistic	Monthly Capacity (MW)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,767	1,807	1,854	1,883	1,910	1,941	1,942	1,899	1,825	1,767	1,751	1,733
20%	1,731	1,790	1,829	1,862	1,891	1,923	1,907	1,856	1,739	1,676	1,669	1,677
30%	1,687	1,768	1,809	1,849	1,876	1,899	1,890	1,808	1,695	1,620	1,608	1,647
40%	1,645	1,727	1,787	1,832	1,865	1,879	1,857	1,770	1,654	1,590	1,571	1,574
50%	1,583	1,686	1,750	1,811	1,846	1,855	1,832	1,745	1,612	1,550	1,541	1,544
60%	1,561	1,629	1,710	1,768	1,811	1,831	1,788	1,701	1,584	1,509	1,487	1,488
70%	1,482	1,568	1,650	1,714	1,771	1,786	1,760	1,669	1,550	1,471	1,439	1,448
80%	1,379	1,450	1,576	1,644	1,719	1,747	1,713	1,616	1,490	1,391	1,387	1,375
90%	1,197	1,360	1,427	1,535	1,569	1,552	1,523	1,429	1,335	1,222	1,183	1,134
Long Term												
Full Simulation Period ^b	1,532	1,606	1,675	1,735	1,780	1,795	1,772	1,693	1,574	1,492	1,469	1,474
Water Year Types^c												
Wet (32%)	1,679	1,756	1,811	1,857	1,892	1,926	1,920	1,871	1,773	1,717	1,694	1,701
Above Normal (16%)	1,522	1,652	1,747	1,810	1,856	1,877	1,860	1,778	1,653	1,584	1,567	1,564
Below Normal (13%)	1,606	1,671	1,754	1,792	1,830	1,838	1,807	1,718	1,593	1,496	1,481	1,487
Dry (24%)	1,476	1,536	1,607	1,689	1,746	1,771	1,746	1,652	1,533	1,463	1,445	1,456
Critical (15%)	1,250	1,290	1,342	1,416	1,466	1,419	1,366	1,262	1,106	948	902	904

Alternative 1 minus No Action Alternative

Statistic	Monthly Capacity (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	5%	4%	2%	2%	1%	2%	3%	3%	2%	1%	5%	5%
20%	6%	4%	3%	2%	2%	3%	3%	3%	1%	-1%	3%	4%
30%	5%	4%	4%	3%	2%	3%	4%	1%	1%	0%	1%	3%
40%	4%	6%	4%	3%	3%	4%	4%	2%	1%	0%	2%	1%
50%	2%	5%	4%	5%	4%	4%	4%	2%	0%	0%	2%	2%
60%	2%	5%	5%	4%	4%	5%	4%	3%	1%	0%	0%	1%
70%	1%	3%	4%	3%	3%	4%	4%	3%	2%	1%	0%	1%
80%	2%	2%	4%	4%	3%	4%	5%	2%	4%	3%	4%	2%
90%	5%	5%	2%	6%	6%	3%	5%	3%	11%	9%	9%	3%
Long Term												
Full Simulation Period ^b	4%	4%	4%	3%	3%	4%	4%	3%	2%	2%	3%	3%
Water Year Types^c												
Wet (32%)	4%	4%	3%	2%	2%	3%	3%	2%	1%	0%	3%	4%
Above Normal (16%)	4%	5%	4%	3%	2%	3%	4%	2%	1%	0%	1%	2%
Below Normal (13%)	5%	6%	5%	4%	4%	5%	5%	3%	2%	0%	0%	0%
Dry (24%)	2%	3%	3%	3%	3%	4%	4%	3%	2%	2%	2%	2%
Critical (15%)	6%	6%	6%	5%	7%	5%	5%	5%	8%	14%	12%	10%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.16.2 CVP Total Capacity, Monthly Capacity

Second Basis of Comparison

Statistic	Monthly Capacity (MW)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,767	1,807	1,854	1,883	1,910	1,941	1,942	1,899	1,825	1,767	1,751	1,733
20%	1,731	1,790	1,829	1,862	1,891	1,923	1,907	1,856	1,739	1,676	1,669	1,677
30%	1,687	1,768	1,809	1,849	1,876	1,899	1,890	1,808	1,695	1,620	1,608	1,647
40%	1,645	1,727	1,787	1,832	1,865	1,879	1,857	1,770	1,654	1,590	1,571	1,574
50%	1,583	1,686	1,750	1,811	1,846	1,855	1,832	1,745	1,612	1,550	1,541	1,544
60%	1,561	1,629	1,710	1,768	1,811	1,831	1,788	1,701	1,584	1,509	1,487	1,488
70%	1,482	1,568	1,650	1,714	1,771	1,786	1,760	1,669	1,550	1,471	1,439	1,448
80%	1,379	1,450	1,576	1,644	1,719	1,747	1,713	1,616	1,490	1,391	1,387	1,375
90%	1,197	1,360	1,427	1,535	1,569	1,552	1,523	1,429	1,335	1,222	1,183	1,134
Long Term												
Full Simulation Period ^b	1,532	1,606	1,675	1,735	1,780	1,795	1,772	1,693	1,574	1,492	1,469	1,474
Water Year Types^c												
Wet (32%)	1,679	1,756	1,811	1,857	1,892	1,926	1,920	1,871	1,773	1,717	1,694	1,701
Above Normal (16%)	1,522	1,652	1,747	1,810	1,856	1,877	1,860	1,778	1,653	1,584	1,567	1,564
Below Normal (13%)	1,606	1,671	1,754	1,792	1,830	1,838	1,807	1,718	1,593	1,496	1,481	1,487
Dry (24%)	1,476	1,536	1,607	1,689	1,746	1,771	1,746	1,652	1,533	1,463	1,445	1,456
Critical (15%)	1,250	1,290	1,342	1,416	1,466	1,419	1,366	1,262	1,106	948	902	904

No Action Alternative

Statistic	Monthly Capacity (MW)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,688	1,743	1,810	1,854	1,883	1,895	1,877	1,848	1,785	1,749	1,670	1,647
20%	1,638	1,724	1,772	1,829	1,858	1,872	1,842	1,806	1,719	1,695	1,623	1,615
30%	1,600	1,694	1,744	1,802	1,837	1,842	1,825	1,782	1,671	1,623	1,585	1,599
40%	1,579	1,635	1,710	1,776	1,811	1,812	1,793	1,736	1,634	1,583	1,545	1,553
50%	1,550	1,611	1,681	1,732	1,778	1,782	1,757	1,711	1,607	1,543	1,510	1,516
60%	1,529	1,556	1,622	1,700	1,749	1,752	1,725	1,652	1,564	1,504	1,481	1,473
70%	1,465	1,519	1,588	1,661	1,712	1,714	1,685	1,618	1,524	1,457	1,433	1,432
80%	1,354	1,428	1,521	1,584	1,666	1,675	1,637	1,578	1,440	1,353	1,332	1,342
90%	1,137	1,293	1,403	1,455	1,476	1,502	1,454	1,384	1,203	1,120	1,085	1,103
Long Term												
Full Simulation Period ^b	1,476	1,542	1,612	1,685	1,727	1,734	1,705	1,648	1,542	1,468	1,429	1,430
Water Year Types^c												
Wet (32%)	1,621	1,696	1,761	1,824	1,860	1,877	1,859	1,831	1,753	1,717	1,645	1,628
Above Normal (16%)	1,465	1,580	1,676	1,762	1,814	1,814	1,793	1,741	1,633	1,590	1,545	1,541
Below Normal (13%)	1,530	1,580	1,669	1,719	1,764	1,757	1,728	1,665	1,559	1,491	1,478	1,483
Dry (24%)	1,441	1,491	1,556	1,637	1,690	1,709	1,680	1,607	1,508	1,434	1,418	1,433
Critical (15%)	1,180	1,221	1,264	1,348	1,374	1,355	1,299	1,205	1,025	832	808	825

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Capacity (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-4%	-4%	-2%	-2%	-1%	-2%	-3%	-3%	-2%	-1%	-5%	-5%
20%	-5%	-4%	-3%	-2%	-2%	-3%	-3%	-3%	-1%	1%	-3%	-4%
30%	-5%	-4%	-4%	-3%	-2%	-3%	-3%	-1%	-1%	0%	-1%	-3%
40%	-4%	-5%	-4%	-3%	-3%	-4%	-3%	-2%	-1%	0%	-2%	-1%
50%	-2%	-4%	-4%	-4%	-4%	-4%	-4%	-2%	0%	0%	-2%	-2%
60%	-2%	-5%	-5%	-4%	-3%	-4%	-3%	-3%	-1%	0%	0%	-1%
70%	-1%	-3%	-4%	-3%	-3%	-4%	-4%	-3%	-2%	-1%	0%	-1%
80%	-2%	-2%	-4%	-4%	-3%	-4%	-4%	-2%	-3%	-3%	-4%	-2%
90%	-5%	-5%	-2%	-5%	-6%	-3%	-4%	-3%	-10%	-8%	-8%	-3%
Long Term												
Full Simulation Period ^b	-4%	-4%	-4%	-3%	-3%	-3%	-4%	-3%	-2%	-2%	-3%	-3%
Water Year Types^c												
Wet (32%)	-3%	-3%	-3%	-2%	-2%	-3%	-3%	-2%	-1%	0%	-3%	-4%
Above Normal (16%)	-4%	-4%	-4%	-3%	-2%	-3%	-4%	-2%	-1%	0%	-1%	-2%
Below Normal (13%)	-5%	-5%	-5%	-4%	-4%	-4%	-4%	-3%	-2%	0%	0%	0%
Dry (24%)	-2%	-3%	-3%	-3%	-3%	-4%	-4%	-3%	-2%	-2%	-2%	-2%
Critical (15%)	-6%	-5%	-6%	-5%	-6%	-5%	-5%	-5%	-7%	-12%	-10%	-9%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.16.3 CVP Total Capacity, Monthly Capacity

Second Basis of Comparison

Statistic	Monthly Capacity (MW)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,767	1,807	1,854	1,883	1,910	1,941	1,942	1,899	1,825	1,767	1,751	1,733
20%	1,731	1,790	1,829	1,862	1,891	1,923	1,907	1,856	1,739	1,676	1,669	1,677
30%	1,687	1,768	1,809	1,849	1,876	1,899	1,890	1,808	1,695	1,620	1,608	1,647
40%	1,645	1,727	1,787	1,832	1,865	1,879	1,857	1,770	1,654	1,590	1,571	1,574
50%	1,583	1,686	1,750	1,811	1,846	1,855	1,832	1,745	1,612	1,550	1,541	1,544
60%	1,561	1,629	1,710	1,768	1,811	1,831	1,788	1,701	1,584	1,509	1,487	1,488
70%	1,482	1,568	1,650	1,714	1,771	1,786	1,760	1,669	1,550	1,471	1,439	1,448
80%	1,379	1,450	1,576	1,644	1,719	1,747	1,713	1,616	1,490	1,391	1,387	1,375
90%	1,197	1,360	1,427	1,535	1,569	1,552	1,523	1,429	1,335	1,222	1,183	1,134
Long Term												
Full Simulation Period ^b	1,532	1,606	1,675	1,735	1,780	1,795	1,772	1,693	1,574	1,492	1,469	1,474
Water Year Types^c												
Wet (32%)	1,679	1,756	1,811	1,857	1,892	1,926	1,920	1,871	1,773	1,717	1,694	1,701
Above Normal (16%)	1,522	1,652	1,747	1,810	1,856	1,877	1,860	1,778	1,653	1,584	1,567	1,564
Below Normal (13%)	1,606	1,671	1,754	1,792	1,830	1,838	1,807	1,718	1,593	1,496	1,481	1,487
Dry (24%)	1,476	1,536	1,607	1,689	1,746	1,771	1,746	1,652	1,533	1,463	1,445	1,456
Critical (15%)	1,250	1,290	1,342	1,416	1,466	1,419	1,366	1,262	1,106	948	902	904

Alternative 3

Statistic	Monthly Capacity (MW)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,778	1,818	1,852	1,884	1,910	1,945	1,947	1,910	1,837	1,777	1,759	1,753
20%	1,749	1,789	1,828	1,860	1,894	1,930	1,930	1,883	1,766	1,692	1,687	1,696
30%	1,708	1,772	1,814	1,851	1,884	1,900	1,895	1,828	1,717	1,654	1,633	1,659
40%	1,663	1,741	1,781	1,838	1,866	1,882	1,849	1,777	1,670	1,601	1,604	1,600
50%	1,609	1,689	1,744	1,800	1,840	1,851	1,821	1,760	1,644	1,572	1,554	1,569
60%	1,579	1,639	1,695	1,748	1,797	1,814	1,781	1,711	1,603	1,542	1,511	1,510
70%	1,499	1,557	1,632	1,703	1,768	1,784	1,755	1,665	1,567	1,487	1,453	1,465
80%	1,394	1,457	1,570	1,624	1,708	1,738	1,707	1,620	1,506	1,408	1,378	1,372
90%	1,231	1,365	1,434	1,496	1,518	1,545	1,519	1,453	1,343	1,229	1,190	1,181
Long Term												
Full Simulation Period ^b	1,551	1,613	1,676	1,732	1,777	1,794	1,775	1,705	1,592	1,512	1,486	1,493
Water Year Types^c												
Wet (32%)	1,690	1,756	1,806	1,856	1,894	1,929	1,928	1,885	1,791	1,730	1,713	1,716
Above Normal (16%)	1,527	1,640	1,746	1,802	1,852	1,875	1,862	1,786	1,679	1,615	1,591	1,589
Below Normal (13%)	1,629	1,676	1,751	1,790	1,829	1,832	1,788	1,718	1,607	1,529	1,504	1,501
Dry (24%)	1,504	1,551	1,612	1,686	1,748	1,768	1,745	1,660	1,555	1,479	1,459	1,475
Critical (15%)	1,283	1,319	1,355	1,411	1,444	1,422	1,386	1,288	1,113	967	909	930

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Capacity (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1%	1%	0%	0%	0%	0%	0%	1%	1%	1%	0%	1%
20%	1%	0%	0%	0%	0%	0%	1%	1%	2%	1%	1%	1%
30%	1%	0%	0%	0%	0%	0%	0%	1%	1%	2%	2%	1%
40%	1%	1%	0%	0%	0%	0%	0%	0%	1%	1%	2%	2%
50%	2%	0%	0%	-1%	0%	0%	-1%	1%	2%	1%	1%	2%
60%	1%	1%	-1%	-1%	-1%	-1%	0%	1%	1%	2%	2%	1%
70%	1%	-1%	-1%	-1%	0%	0%	0%	0%	1%	1%	1%	1%
80%	1%	0%	0%	-1%	-1%	-1%	0%	0%	1%	1%	-1%	0%
90%	3%	0%	0%	-3%	-3%	-1%	0%	2%	1%	1%	1%	4%
Long Term												
Full Simulation Period ^b	1%	0%	0%	0%	0%	0%	0%	1%	1%	1%	1%	1%
Water Year Types^c												
Wet (32%)	1%	0%	0%	0%	0%	0%	0%	1%	1%	1%	1%	1%
Above Normal (16%)	0%	-1%	0%	0%	0%	0%	0%	0%	2%	2%	1%	2%
Below Normal (13%)	1%	0%	0%	0%	0%	0%	-1%	0%	1%	2%	2%	1%
Dry (24%)	2%	1%	0%	0%	0%	0%	0%	1%	1%	1%	1%	1%
Critical (15%)	3%	2%	1%	0%	-1%	0%	1%	2%	1%	2%	1%	3%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.16.4 CVP Total Capacity, Monthly Capacity

Second Basis of Comparison

Statistic	Monthly Capacity (MW)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,767	1,807	1,854	1,883	1,910	1,941	1,942	1,899	1,825	1,767	1,751	1,733
20%	1,731	1,790	1,829	1,862	1,891	1,923	1,907	1,856	1,739	1,676	1,669	1,677
30%	1,687	1,768	1,809	1,849	1,876	1,899	1,890	1,808	1,695	1,620	1,608	1,647
40%	1,645	1,727	1,787	1,832	1,865	1,879	1,857	1,770	1,654	1,590	1,571	1,574
50%	1,583	1,686	1,750	1,811	1,846	1,855	1,832	1,745	1,612	1,550	1,541	1,544
60%	1,561	1,629	1,710	1,768	1,811	1,831	1,788	1,701	1,584	1,509	1,487	1,488
70%	1,482	1,568	1,650	1,714	1,771	1,786	1,760	1,669	1,550	1,471	1,439	1,448
80%	1,379	1,450	1,576	1,644	1,719	1,747	1,713	1,616	1,490	1,391	1,387	1,375
90%	1,197	1,360	1,427	1,535	1,569	1,552	1,523	1,429	1,335	1,222	1,183	1,134
Long Term												
Full Simulation Period ^b	1,532	1,606	1,675	1,735	1,780	1,795	1,772	1,693	1,574	1,492	1,469	1,474
Water Year Types^c												
Wet (32%)	1,679	1,756	1,811	1,857	1,892	1,926	1,920	1,871	1,773	1,717	1,694	1,701
Above Normal (16%)	1,522	1,652	1,747	1,810	1,856	1,877	1,860	1,778	1,653	1,584	1,567	1,564
Below Normal (13%)	1,606	1,671	1,754	1,792	1,830	1,838	1,807	1,718	1,593	1,496	1,481	1,487
Dry (24%)	1,476	1,536	1,607	1,689	1,746	1,771	1,746	1,652	1,533	1,463	1,445	1,456
Critical (15%)	1,250	1,290	1,342	1,416	1,466	1,419	1,366	1,262	1,106	948	902	904

Alternative 5

Statistic	Monthly Capacity (MW)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,693	1,746	1,805	1,849	1,882	1,891	1,879	1,849	1,777	1,748	1,671	1,650
20%	1,635	1,721	1,772	1,829	1,859	1,867	1,843	1,806	1,725	1,690	1,624	1,612
30%	1,599	1,680	1,744	1,797	1,836	1,839	1,816	1,766	1,655	1,616	1,576	1,579
40%	1,566	1,638	1,710	1,767	1,801	1,801	1,785	1,732	1,619	1,571	1,538	1,547
50%	1,538	1,596	1,668	1,726	1,775	1,774	1,737	1,700	1,598	1,555	1,504	1,510
60%	1,516	1,552	1,617	1,687	1,737	1,733	1,701	1,643	1,537	1,484	1,460	1,457
70%	1,458	1,512	1,571	1,650	1,694	1,699	1,673	1,596	1,506	1,415	1,413	1,413
80%	1,327	1,399	1,504	1,574	1,644	1,639	1,616	1,532	1,439	1,324	1,302	1,310
90%	1,044	1,242	1,372	1,427	1,440	1,483	1,450	1,351	1,173	1,061	1,046	1,029
Long Term												
Full Simulation Period ^b	1,460	1,532	1,603	1,672	1,716	1,717	1,692	1,633	1,525	1,450	1,410	1,410
Water Year Types^c												
Wet (32%)	1,609	1,690	1,755	1,819	1,856	1,873	1,858	1,830	1,748	1,715	1,641	1,625
Above Normal (16%)	1,458	1,576	1,671	1,757	1,808	1,806	1,785	1,735	1,624	1,577	1,536	1,532
Below Normal (13%)	1,504	1,559	1,648	1,712	1,755	1,743	1,710	1,653	1,546	1,474	1,465	1,468
Dry (24%)	1,428	1,478	1,545	1,622	1,676	1,686	1,657	1,585	1,485	1,403	1,383	1,391
Critical (15%)	1,152	1,205	1,253	1,308	1,344	1,310	1,274	1,159	985	793	768	794

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Capacity (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-4%	-3%	-3%	-2%	-1%	-3%	-3%	-3%	-3%	-1%	-5%	-5%
20%	-6%	-4%	-3%	-2%	-2%	-3%	-3%	-3%	-1%	1%	-3%	-4%
30%	-5%	-5%	-4%	-3%	-2%	-3%	-4%	-2%	0%	-2%	-4%	-4%
40%	-5%	-5%	-4%	-4%	-3%	-4%	-4%	-2%	-1%	-2%	-2%	-2%
50%	-3%	-5%	-5%	-5%	-4%	-4%	-5%	-3%	-1%	0%	-2%	-2%
60%	-3%	-5%	-5%	-5%	-4%	-5%	-5%	-3%	-3%	-2%	-2%	-2%
70%	-2%	-4%	-5%	-4%	-4%	-5%	-5%	-4%	-3%	-4%	-2%	-2%
80%	-4%	-4%	-5%	-4%	-4%	-6%	-6%	-5%	-3%	-5%	-6%	-5%
90%	-13%	-9%	-4%	-7%	-8%	-4%	-5%	-6%	-12%	-13%	-12%	-9%
Long Term												
Full Simulation Period ^b	-5%	-5%	-4%	-4%	-4%	-4%	-4%	-4%	-3%	-3%	-4%	-4%
Water Year Types^c												
Wet (32%)	-4%	-4%	-3%	-2%	-2%	-3%	-3%	-2%	-1%	0%	-3%	-4%
Above Normal (16%)	-4%	-5%	-4%	-3%	-3%	-4%	-4%	-2%	-2%	0%	-2%	-2%
Below Normal (13%)	-6%	-7%	-6%	-4%	-4%	-5%	-5%	-4%	-3%	-1%	-1%	-1%
Dry (24%)	-3%	-4%	-4%	-4%	-4%	-5%	-5%	-4%	-3%	-4%	-4%	-5%
Critical (15%)	-8%	-7%	-7%	-8%	-8%	-8%	-7%	-8%	-11%	-16%	-15%	-12%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

5C.3.3.17 CVP Total Generation

Table 5C.3.3.17.1 CVP Total Generation, Monthly Generation

No Action Alternative

Statistic	Monthly Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	409	413	641	689	671	696	492	616	619	756	585	630
20%	372	380	338	490	622	569	397	549	577	729	549	597
30%	329	310	240	381	471	363	358	514	561	705	536	469
40%	292	274	190	235	245	267	334	478	544	662	511	414
50%	270	231	175	201	205	229	318	464	527	644	496	342
60%	239	183	167	179	173	194	302	442	495	630	476	285
70%	210	162	146	152	141	171	282	415	479	598	451	250
80%	186	140	131	137	130	151	249	350	435	551	421	215
90%	159	118	105	120	110	141	217	291	350	474	359	184
Long Term												
Full Simulation Period ^b	273	255	260	317	322	329	343	461	514	631	487	376
Water Year Types^c												
Wet (32%)	317	318	441	558	513	557	447	580	568	683	542	598
Above Normal (16%)	268	263	259	320	454	367	370	484	544	708	527	421
Below Normal (13%)	310	258	175	186	266	220	318	455	540	679	529	289
Dry (24%)	254	232	154	183	145	183	263	406	511	607	457	246
Critical (15%)	184	149	123	134	111	135	242	271	345	431	333	145

Alternative 1

Statistic	Monthly Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	415	295	659	692	684	702	486	626	696	779	637	441
20%	339	256	436	584	637	584	393	572	655	757	588	370
30%	303	233	242	439	446	357	350	535	623	732	569	334
40%	268	220	194	266	287	256	325	507	602	711	549	315
50%	236	204	182	211	220	232	313	493	577	683	525	297
60%	212	180	169	177	175	194	289	470	553	654	501	278
70%	201	168	148	156	141	177	276	445	530	627	477	258
80%	172	138	134	143	133	154	248	372	481	571	436	225
90%	152	125	112	121	115	141	217	318	390	470	389	186
Long Term												
Full Simulation Period ^b	256	215	278	336	331	334	334	481	569	655	514	305
Water Year Types^c												
Wet (32%)	297	269	491	582	521	549	428	586	636	697	573	399
Above Normal (16%)	245	215	245	362	479	396	341	513	618	740	571	341
Below Normal (13%)	282	221	188	231	280	246	323	496	612	724	575	306
Dry (24%)	243	183	158	179	150	181	262	433	542	637	463	251
Critical (15%)	180	145	134	134	107	140	253	286	376	442	357	154

Alternative 1 minus No Action Alternative

Statistic	Monthly Generation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2%	-29%	3%	0%	2%	1%	-1%	2%	12%	3%	9%	-30%
20%	-9%	-33%	29%	19%	2%	3%	-1%	4%	14%	4%	7%	-38%
30%	-8%	-25%	1%	15%	-5%	-2%	-2%	4%	11%	4%	6%	-29%
40%	-8%	-20%	2%	13%	17%	-4%	-3%	6%	11%	7%	7%	-24%
50%	-12%	-12%	4%	5%	7%	1%	-2%	6%	9%	6%	6%	-13%
60%	-12%	-2%	1%	-1%	1%	0%	-4%	6%	12%	4%	5%	-2%
70%	-4%	3%	1%	3%	0%	4%	-2%	7%	11%	5%	6%	3%
80%	-8%	-2%	3%	4%	2%	2%	0%	6%	11%	4%	4%	4%
90%	-4%	6%	7%	1%	5%	0%	0%	9%	11%	-1%	8%	1%
Long Term												
Full Simulation Period ^b	-6%	-16%	7%	6%	3%	2%	-3%	5%	11%	4%	6%	-19%
Water Year Types^c												
Wet (32%)	-6%	-15%	11%	4%	1%	-1%	-4%	1%	12%	2%	6%	-33%
Above Normal (16%)	-8%	-18%	-6%	13%	6%	8%	-8%	6%	14%	5%	8%	-19%
Below Normal (13%)	-9%	-14%	7%	24%	5%	12%	1%	9%	13%	7%	9%	6%
Dry (24%)	-4%	-21%	2%	-2%	4%	-1%	0%	7%	6%	5%	1%	2%
Critical (15%)	-2%	-3%	9%	0%	-4%	4%	5%	6%	9%	3%	7%	6%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.17.2 CVP Total Generation, Monthly Generation

Second Basis of Comparison

Statistic	Monthly Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	415	295	659	692	684	702	486	626	696	779	637	441
20%	339	256	436	584	637	584	393	572	655	757	588	370
30%	303	233	242	439	446	357	350	535	623	732	569	334
40%	268	220	194	266	287	256	325	507	602	711	549	315
50%	236	204	182	211	220	232	313	493	577	683	525	297
60%	212	180	169	177	175	194	289	470	553	654	501	278
70%	201	168	148	156	141	177	276	445	530	627	477	258
80%	172	138	134	143	133	154	248	372	481	571	436	225
90%	152	125	112	121	115	141	217	318	390	470	389	186
Long Term												
Full Simulation Period ^b	256	215	278	336	331	334	334	481	569	655	514	305
Water Year Types^c												
Wet (32%)	297	269	491	582	521	549	428	586	636	697	573	399
Above Normal (16%)	245	215	245	362	479	396	341	513	618	740	571	341
Below Normal (13%)	282	221	188	231	280	246	323	496	612	724	575	306
Dry (24%)	243	183	158	179	150	181	262	433	542	637	463	251
Critical (15%)	180	145	134	134	107	140	253	286	376	442	357	154

No Action Alternative

Statistic	Monthly Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	409	413	641	689	671	696	492	616	619	756	585	630
20%	372	380	338	490	622	569	397	549	577	729	549	597
30%	329	310	240	381	471	363	358	514	561	705	536	469
40%	292	274	190	235	245	267	334	478	544	662	511	414
50%	270	231	175	201	205	229	318	464	527	644	496	342
60%	239	183	167	179	173	194	302	442	495	630	476	285
70%	210	162	146	152	141	171	282	415	479	598	451	250
80%	186	140	131	137	130	151	249	350	435	551	421	215
90%	159	118	105	120	110	141	217	291	350	474	359	184
Long Term												
Full Simulation Period ^b	273	255	260	317	322	329	343	461	514	631	487	376
Water Year Types^c												
Wet (32%)	317	318	441	558	513	557	447	580	568	683	542	598
Above Normal (16%)	268	263	259	320	454	367	370	484	544	708	527	421
Below Normal (13%)	310	258	175	186	266	220	318	455	540	679	529	289
Dry (24%)	254	232	154	183	145	183	263	406	511	607	457	246
Critical (15%)	184	149	123	134	111	135	242	271	345	431	333	145

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Generation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-2%	40%	-3%	0%	-2%	-1%	1%	-1%	-11%	-3%	-8%	43%
20%	10%	49%	-22%	-16%	-2%	-2%	1%	-4%	-12%	-4%	-6%	61%
30%	8%	33%	-1%	-13%	6%	2%	2%	-4%	-10%	-4%	-6%	40%
40%	9%	25%	-2%	-11%	-14%	4%	3%	-6%	-10%	-7%	-7%	31%
50%	14%	13%	-4%	-5%	-7%	-1%	2%	-6%	-9%	-6%	-6%	15%
60%	13%	2%	-1%	1%	-1%	0%	4%	-6%	-10%	-4%	-5%	3%
70%	5%	-3%	-1%	-3%	0%	-4%	2%	-7%	-10%	-5%	-5%	-3%
80%	8%	2%	-2%	-4%	-2%	0%	0%	-6%	-10%	-4%	-3%	-4%
90%	5%	-5%	-7%	-1%	-5%	0%	0%	-9%	-10%	1%	-8%	-1%
Long Term												
Full Simulation Period ^b	7%	19%	-6%	-6%	-3%	-2%	3%	-4%	-10%	-4%	-5%	23%
Water Year Types^c												
Wet (32%)	7%	18%	-10%	-4%	-1%	1%	5%	-1%	-11%	-2%	-5%	50%
Above Normal (16%)	9%	22%	6%	-12%	-5%	-7%	8%	-6%	-12%	-4%	-8%	23%
Below Normal (13%)	10%	17%	-7%	-19%	-5%	-11%	-1%	-8%	-12%	-6%	-8%	-5%
Dry (24%)	5%	27%	-2%	2%	-4%	1%	0%	-6%	-6%	-5%	-1%	-2%
Critical (15%)	2%	3%	-8%	0%	4%	-4%	-4%	-5%	-8%	-2%	-7%	-6%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.17.3 CVP Total Generation, Monthly Generation

Second Basis of Comparison

Statistic	Monthly Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	415	295	659	692	684	702	486	626	696	779	637	441
20%	339	256	436	584	637	584	393	572	655	757	588	370
30%	303	233	242	439	446	357	350	535	623	732	569	334
40%	268	220	194	266	287	256	325	507	602	711	549	315
50%	236	204	182	211	220	232	313	493	577	683	525	297
60%	212	180	169	177	175	194	289	470	553	654	501	278
70%	201	168	148	156	141	177	276	445	530	627	477	258
80%	172	138	134	143	133	154	248	372	481	571	436	225
90%	152	125	112	121	115	141	217	318	390	470	389	186
Long Term												
Full Simulation Period ^b	256	215	278	336	331	334	334	481	569	655	514	305
Water Year Types^c												
Wet (32%)	297	269	491	582	521	549	428	586	636	697	573	399
Above Normal (16%)	245	215	245	362	479	396	341	513	618	740	571	341
Below Normal (13%)	282	221	188	231	280	246	323	496	612	724	575	306
Dry (24%)	243	183	158	179	150	181	262	433	542	637	463	251
Critical (15%)	180	145	134	134	107	140	253	286	376	442	357	154

Alternative 3

Statistic	Monthly Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	415	306	662	691	701	710	489	598	648	775	610	459
20%	342	256	426	590	650	583	393	551	635	759	578	387
30%	314	227	242	427	458	367	360	507	590	741	557	358
40%	275	216	199	254	283	258	330	493	564	720	538	328
50%	245	204	181	203	220	223	314	469	548	678	525	302
60%	222	180	170	173	179	192	291	442	518	657	513	279
70%	202	164	149	156	142	171	271	421	511	624	482	257
80%	176	145	133	134	128	153	250	363	453	561	445	227
90%	158	124	113	122	109	136	222	300	381	474	387	191
Long Term												
Full Simulation Period ^b	262	215	279	333	336	335	338	462	542	658	512	314
Water Year Types^c												
Wet (32%)	298	268	493	584	537	551	430	562	593	712	576	407
Above Normal (16%)	249	222	245	350	477	401	346	482	580	736	550	341
Below Normal (13%)	284	211	187	228	283	245	332	476	580	711	557	347
Dry (24%)	256	184	162	175	146	180	265	416	532	635	471	251
Critical (15%)	189	150	132	130	113	139	253	285	373	445	360	160

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Generation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	4%	1%	0%	2%	1%	1%	-4%	-7%	0%	-4%	4%
20%	1%	0%	-2%	1%	2%	0%	0%	-4%	-3%	0%	-2%	5%
30%	4%	-3%	0%	-3%	3%	3%	3%	-5%	-5%	1%	-2%	7%
40%	2%	-2%	3%	-4%	-1%	1%	2%	-3%	-6%	1%	-2%	4%
50%	4%	0%	-1%	-4%	0%	-4%	0%	-5%	-5%	-1%	0%	2%
60%	5%	0%	1%	-2%	2%	-1%	1%	-6%	-6%	1%	2%	0%
70%	1%	-2%	1%	0%	1%	-3%	-2%	-5%	-4%	-1%	1%	0%
80%	2%	5%	-1%	-6%	-4%	-1%	1%	-3%	-6%	-2%	2%	1%
90%	4%	-1%	1%	0%	-6%	-4%	2%	-6%	-2%	1%	-1%	3%
Long Term												
Full Simulation Period ^b	2%	0%	1%	-1%	2%	0%	1%	-4%	-5%	0%	0%	3%
Water Year Types^c												
Wet (32%)	0%	-1%	1%	0%	3%	0%	1%	-4%	-7%	2%	1%	2%
Above Normal (16%)	2%	3%	0%	-3%	0%	1%	1%	-6%	-6%	-1%	-4%	0%
Below Normal (13%)	1%	-5%	0%	-1%	1%	-1%	3%	-4%	-5%	-2%	-3%	14%
Dry (24%)	5%	1%	3%	-2%	-3%	0%	1%	-4%	-2%	0%	2%	0%
Critical (15%)	5%	4%	-2%	-3%	6%	-1%	0%	0%	-1%	1%	1%	4%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.17.4 CVP Total Generation, Monthly Generation

Second Basis of Comparison

Statistic	Monthly Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	415	295	659	692	684	702	486	626	696	779	637	441
20%	339	256	436	584	637	584	393	572	655	757	588	370
30%	303	233	242	439	446	357	350	535	623	732	569	334
40%	268	220	194	266	287	256	325	507	602	711	549	315
50%	236	204	182	211	220	232	313	493	577	683	525	297
60%	212	180	169	177	175	194	289	470	553	654	501	278
70%	201	168	148	156	141	177	276	445	530	627	477	258
80%	172	138	134	143	133	154	248	372	481	571	436	225
90%	152	125	112	121	115	141	217	318	390	470	389	186
Long Term												
Full Simulation Period ^b	256	215	278	336	331	334	334	481	569	655	514	305
Water Year Types^c												
Wet (32%)	297	269	491	582	521	549	428	586	636	697	573	399
Above Normal (16%)	245	215	245	362	479	396	341	513	618	740	571	341
Below Normal (13%)	282	221	188	231	280	246	323	496	612	724	575	306
Dry (24%)	243	183	158	179	150	181	262	433	542	637	463	251
Critical (15%)	180	145	134	134	107	140	253	286	376	442	357	154

Alternative 5

Statistic	Monthly Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	404	410	647	689	671	694	491	627	618	752	574	628
20%	365	380	341	486	622	563	404	562	578	722	553	598
30%	328	316	236	381	459	362	368	513	557	705	534	468
40%	284	281	188	233	245	266	334	482	541	660	514	418
50%	269	226	173	201	205	229	327	460	525	648	498	351
60%	244	182	163	178	173	199	304	439	493	634	471	277
70%	220	161	145	153	139	170	281	412	472	601	451	248
80%	183	140	131	137	127	151	258	343	432	548	416	217
90%	155	113	102	120	108	136	233	308	350	463	365	184
Long Term												
Full Simulation Period ^b	273	254	258	317	321	328	348	463	509	628	485	378
Water Year Types^c												
Wet (32%)	313	320	438	558	512	554	446	585	567	685	538	598
Above Normal (16%)	266	254	259	321	454	368	370	489	542	708	523	419
Below Normal (13%)	307	257	173	186	265	221	334	458	533	675	520	294
Dry (24%)	254	231	153	183	145	183	273	404	505	604	459	247
Critical (15%)	192	149	120	135	110	132	250	270	336	414	337	153

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Generation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-3%	39%	-2%	0%	-2%	-1%	1%	0%	-11%	-3%	-10%	42%
20%	8%	48%	-22%	-17%	-2%	-4%	3%	-2%	-12%	-5%	-6%	62%
30%	8%	36%	-2%	-13%	3%	1%	5%	-4%	-11%	-4%	-6%	40%
40%	6%	28%	-3%	-12%	-14%	4%	3%	-5%	-10%	-7%	-6%	33%
50%	14%	11%	-5%	-5%	-7%	-1%	4%	-7%	-9%	-5%	-5%	18%
60%	15%	1%	-4%	1%	-1%	3%	5%	-7%	-11%	-3%	-6%	0%
70%	10%	-4%	-2%	-2%	-2%	-4%	2%	-7%	-11%	-4%	-5%	-4%
80%	6%	1%	-2%	-4%	-4%	-2%	4%	-8%	-10%	-4%	-5%	-4%
90%	2%	-9%	-9%	-1%	-6%	-3%	7%	-3%	-10%	-2%	-6%	-1%
Long Term												
Full Simulation Period ^b	6%	18%	-7%	-6%	-3%	-2%	4%	-4%	-10%	-4%	-6%	24%
Water Year Types^c												
Wet (32%)	6%	19%	-11%	-4%	-2%	1%	4%	0%	-11%	-2%	-6%	50%
Above Normal (16%)	8%	18%	6%	-11%	-5%	-7%	8%	-5%	-12%	-4%	-8%	23%
Below Normal (13%)	9%	16%	-7%	-20%	-5%	-10%	3%	-8%	-13%	-7%	-10%	-4%
Dry (24%)	4%	26%	-3%	3%	-4%	1%	4%	-7%	-7%	-5%	-1%	-2%
Critical (15%)	7%	3%	-10%	0%	3%	-6%	-1%	-6%	-11%	-6%	-5%	-1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

5C.3.3.18 CVP Total Energy Use

Table 5C.3.3.18.1 CVP Total Energy Use, Monthly Energy Use

No Action Alternative

Statistic	Monthly Energy Use (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	111	171	154	153	146	149	60	69	128	153	133	106
20%	95	150	149	131	133	138	43	46	103	139	122	105
30%	85	139	142	118	115	109	37	41	88	122	114	103
40%	76	129	134	113	99	98	35	39	78	114	109	96
50%	72	105	129	110	94	75	32	36	65	104	102	87
60%	67	93	123	105	85	65	31	33	58	93	94	76
70%	62	81	115	95	72	61	29	30	44	84	79	68
80%	57	65	96	83	47	46	25	26	34	69	59	58
90%	54	58	74	71	31	22	21	21	21	42	36	45
Long Term												
Full Simulation Period ^b	76	111	121	108	92	86	36	40	71	101	93	82
Water Year Types^c												
Wet (32%)	81	125	130	124	125	122	50	58	113	132	119	94
Above Normal (16%)	74	120	123	97	91	104	36	40	85	99	108	87
Below Normal (13%)	79	122	132	107	84	76	30	33	61	106	106	92
Dry (24%)	76	103	120	108	77	64	30	30	42	90	65	72
Critical (15%)	65	73	89	85	52	31	21	22	22	51	56	57

Alternative 1

Statistic	Monthly Energy Use (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	137	151	163	173	183	144	83	90	114	161	182	109
20%	121	141	160	167	149	127	81	65	105	156	154	108
30%	117	139	157	164	143	101	80	59	96	145	132	107
40%	96	134	156	162	139	80	75	54	91	140	128	106
50%	74	124	152	160	135	69	69	47	88	131	124	104
60%	67	109	144	158	116	67	59	45	78	119	109	90
70%	57	96	127	151	84	62	49	38	65	98	86	81
80%	46	80	111	124	55	52	36	29	43	85	63	68
90%	34	66	87	81	27	30	22	23	26	43	39	49
Long Term												
Full Simulation Period ^b	85	115	136	149	115	84	60	51	78	119	113	93
Water Year Types^c												
Wet (32%)	100	132	154	168	139	94	77	69	102	145	150	110
Above Normal (16%)	76	116	136	151	128	94	78	58	100	129	135	117
Below Normal (13%)	92	134	148	158	104	85	61	52	85	146	137	94
Dry (24%)	86	103	124	143	104	83	44	36	55	107	68	75
Critical (15%)	53	78	106	105	79	50	30	26	30	46	63	56

Alternative 1 minus No Action Alternative

Statistic	Monthly Energy Use (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	23%	-12%	6%	13%	26%	-3%	39%	31%	-11%	6%	37%	3%
20%	27%	-6%	7%	27%	12%	-8%	89%	41%	2%	12%	27%	3%
30%	38%	-1%	11%	40%	24%	-7%	113%	44%	10%	19%	16%	3%
40%	26%	4%	16%	43%	41%	-19%	116%	38%	17%	23%	18%	10%
50%	4%	18%	18%	45%	44%	-8%	112%	33%	34%	26%	22%	20%
60%	0%	17%	17%	50%	36%	3%	92%	36%	34%	28%	16%	17%
70%	-8%	18%	10%	58%	17%	2%	69%	25%	46%	17%	9%	19%
80%	-20%	24%	15%	51%	17%	13%	44%	11%	28%	23%	6%	18%
90%	-38%	14%	17%	15%	-13%	34%	4%	8%	23%	2%	7%	10%
Long Term												
Full Simulation Period ^b	11%	4%	13%	37%	26%	-2%	67%	26%	9%	17%	21%	13%
Water Year Types^c												
Wet (32%)	22%	5%	19%	35%	12%	-23%	54%	18%	-10%	9%	26%	17%
Above Normal (16%)	2%	-3%	11%	56%	41%	-10%	118%	42%	18%	30%	25%	34%
Below Normal (13%)	17%	10%	12%	48%	24%	11%	104%	56%	38%	38%	30%	2%
Dry (24%)	12%	0%	3%	32%	35%	30%	44%	20%	32%	19%	4%	4%
Critical (15%)	-18%	6%	19%	22%	51%	64%	46%	15%	34%	-9%	12%	-1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.18.2 CVP Total Energy Use, Monthly Energy Use

Second Basis of Comparison

Statistic	Monthly Energy Use (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	137	151	163	173	183	144	83	90	114	161	182	109
20%	121	141	160	167	149	127	81	65	105	156	154	108
30%	117	139	157	164	143	101	80	59	96	145	132	107
40%	96	134	156	162	139	80	75	54	91	140	128	106
50%	74	124	152	160	135	69	69	47	88	131	124	104
60%	67	109	144	158	116	67	59	45	78	119	109	90
70%	57	96	127	151	84	62	49	38	65	98	86	81
80%	46	80	111	124	55	52	36	29	43	85	63	68
90%	34	66	87	81	27	30	22	23	26	43	39	49
Long Term												
Full Simulation Period ^b	85	115	136	149	115	84	60	51	78	119	113	93
Water Year Types^c												
Wet (32%)	100	132	154	168	139	94	77	69	102	145	150	110
Above Normal (16%)	76	116	136	151	128	94	78	58	100	129	135	117
Below Normal (13%)	92	134	148	158	104	85	61	52	85	146	137	94
Dry (24%)	86	103	124	143	104	83	44	36	55	107	68	75
Critical (15%)	53	78	106	105	79	50	30	26	30	46	63	56

No Action Alternative

Statistic	Monthly Energy Use (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	111	171	154	153	146	149	60	69	128	153	133	106
20%	95	150	149	131	133	138	43	46	103	139	122	105
30%	85	139	142	118	115	109	37	41	88	122	114	103
40%	76	129	134	113	99	98	35	39	78	114	109	96
50%	72	105	129	110	94	75	32	36	65	104	102	87
60%	67	93	123	105	85	65	31	33	58	93	94	76
70%	62	81	115	95	72	61	29	30	44	84	79	68
80%	57	65	96	83	47	46	25	26	34	69	59	58
90%	54	58	74	71	31	22	21	21	21	42	36	45
Long Term												
Full Simulation Period ^b	76	111	121	108	92	86	36	40	71	101	93	82
Water Year Types^c												
Wet (32%)	81	125	130	124	125	122	50	58	113	132	119	94
Above Normal (16%)	74	120	123	97	91	104	36	40	85	99	108	87
Below Normal (13%)	79	122	132	107	84	76	30	33	61	106	106	92
Dry (24%)	76	103	120	108	77	64	30	30	42	90	65	72
Critical (15%)	65	73	89	85	52	31	21	22	22	51	56	57

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Energy Use (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-19%	14%	-5%	-12%	-20%	3%	-28%	-24%	12%	-5%	-27%	-3%
20%	-21%	7%	-7%	-22%	-10%	9%	-47%	-29%	-2%	-11%	-21%	-2%
30%	-28%	1%	-10%	-28%	-20%	7%	-53%	-31%	-9%	-16%	-14%	-3%
40%	-21%	-4%	-14%	-30%	-29%	23%	-54%	-28%	-15%	-19%	-15%	-9%
50%	-4%	-15%	-15%	-31%	-30%	8%	-53%	-25%	-26%	-21%	-18%	-17%
60%	0%	-15%	-15%	-33%	-26%	-3%	-48%	-27%	-25%	-22%	-14%	-15%
70%	9%	-16%	-9%	-37%	-15%	-2%	-41%	-20%	-31%	-14%	-8%	-16%
80%	25%	-19%	-13%	-34%	-15%	-12%	-30%	-10%	-22%	-19%	-6%	-15%
90%	62%	-12%	-15%	-13%	15%	-26%	-4%	-7%	-19%	-2%	-6%	-9%
Long Term												
Full Simulation Period ^b	-10%	-3%	-11%	-27%	-21%	2%	-40%	-21%	-8%	-15%	-18%	-12%
Water Year Types^c												
Wet (32%)	-18%	-5%	-16%	-26%	-10%	30%	-35%	-15%	11%	-9%	-20%	-15%
Above Normal (16%)	-2%	3%	-10%	-36%	-29%	11%	-54%	-30%	-15%	-23%	-20%	-26%
Below Normal (13%)	-14%	-9%	-11%	-32%	-19%	-10%	-51%	-36%	-28%	-28%	-23%	-2%
Dry (24%)	-11%	0%	-3%	-24%	-26%	-23%	-30%	-17%	-24%	-16%	-4%	-4%
Critical (15%)	22%	-6%	-16%	-18%	-34%	-39%	-31%	-13%	-25%	10%	-11%	1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.18.3 CVP Total Energy Use, Monthly Energy Use

Second Basis of Comparison

Statistic	Monthly Energy Use (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	137	151	163	173	183	144	83	90	114	161	182	109
20%	121	141	160	167	149	127	81	65	105	156	154	108
30%	117	139	157	164	143	101	80	59	96	145	132	107
40%	96	134	156	162	139	80	75	54	91	140	128	106
50%	74	124	152	160	135	69	69	47	88	131	124	104
60%	67	109	144	158	116	67	59	45	78	119	109	90
70%	57	96	127	151	84	62	49	38	65	98	86	81
80%	46	80	111	124	55	52	36	29	43	85	63	68
90%	34	66	87	81	27	30	22	23	26	43	39	49
Long Term												
Full Simulation Period ^b	85	115	136	149	115	84	60	51	78	119	113	93
Water Year Types^c												
Wet (32%)	100	132	154	168	139	94	77	69	102	145	150	110
Above Normal (16%)	76	116	136	151	128	94	78	58	100	129	135	117
Below Normal (13%)	92	134	148	158	104	85	61	52	85	146	137	94
Dry (24%)	86	103	124	143	104	83	44	36	55	107	68	75
Critical (15%)	53	78	106	105	79	50	30	26	30	46	63	56

Alternative 3

Statistic	Monthly Energy Use (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	143	149	161	165	151	147	87	99	142	154	156	139
20%	124	140	157	131	142	139	82	89	122	146	134	112
30%	119	138	154	120	126	100	81	79	106	139	132	107
40%	108	128	143	117	105	78	79	72	100	128	128	106
50%	86	118	140	110	91	72	72	66	91	118	113	105
60%	70	107	131	104	75	64	64	53	80	103	99	95
70%	63	95	122	93	65	62	46	40	59	87	83	85
80%	52	82	102	84	54	51	35	30	41	71	62	63
90%	46	66	73	76	31	24	23	23	24	46	41	45
Long Term												
Full Simulation Period ^b	91	113	129	109	95	85	62	62	85	109	106	97
Water Year Types^c												
Wet (32%)	101	130	144	128	135	108	83	87	125	139	140	113
Above Normal (16%)	83	113	122	93	96	125	77	74	105	115	121	111
Below Normal (13%)	94	130	144	111	85	78	56	58	86	123	117	126
Dry (24%)	97	104	126	108	75	65	49	44	54	98	75	74
Critical (15%)	64	78	97	85	53	31	30	25	27	43	55	58

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Energy Use (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4%	-1%	-1%	-5%	-18%	2%	5%	11%	24%	-5%	-14%	27%
20%	2%	-1%	-1%	-21%	-5%	9%	1%	38%	17%	-7%	-13%	4%
30%	2%	0%	-2%	-27%	-12%	-1%	2%	34%	11%	-4%	0%	1%
40%	13%	-5%	-8%	-28%	-25%	-2%	6%	34%	10%	-9%	0%	0%
50%	15%	-4%	-8%	-31%	-32%	4%	4%	40%	3%	-10%	-8%	0%
60%	5%	-2%	-9%	-34%	-35%	-4%	9%	19%	3%	-14%	-9%	7%
70%	10%	-1%	-3%	-39%	-23%	0%	-6%	5%	-9%	-12%	-4%	5%
80%	14%	3%	-8%	-32%	-2%	-2%	-2%	5%	-4%	-16%	-1%	-8%
90%	36%	0%	-16%	-7%	12%	-21%	6%	0%	-7%	8%	7%	-7%
Long Term												
Full Simulation Period ^b	7%	-1%	-5%	-27%	-17%	2%	4%	22%	10%	-8%	-6%	5%
Water Year Types^c												
Wet (32%)	1%	-1%	-7%	-24%	-3%	15%	8%	26%	23%	-4%	-6%	2%
Above Normal (16%)	10%	-3%	-10%	-38%	-25%	33%	-2%	29%	5%	-11%	-10%	-5%
Below Normal (13%)	2%	-3%	-2%	-30%	-18%	-8%	-9%	13%	2%	-16%	-15%	34%
Dry (24%)	13%	1%	2%	-24%	-28%	-21%	12%	20%	-2%	-8%	11%	-1%
Critical (15%)	20%	0%	-8%	-18%	-33%	-39%	0%	-2%	-11%	-7%	-12%	4%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.18.4 CVP Total Energy Use, Monthly Energy Use

Second Basis of Comparison

Statistic	Monthly Energy Use (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	137	151	163	173	183	144	83	90	114	161	182	109
20%	121	141	160	167	149	127	81	65	105	156	154	108
30%	117	139	157	164	143	101	80	59	96	145	132	107
40%	96	134	156	162	139	80	75	54	91	140	128	106
50%	74	124	152	160	135	69	69	47	88	131	124	104
60%	67	109	144	158	116	67	59	45	78	119	109	90
70%	57	96	127	151	84	62	49	38	65	98	86	81
80%	46	80	111	124	55	52	36	29	43	85	63	68
90%	34	66	87	81	27	30	22	23	26	43	39	49
Long Term												
Full Simulation Period ^b	85	115	136	149	115	84	60	51	78	119	113	93
Water Year Types^c												
Wet (32%)	100	132	154	168	139	94	77	69	102	145	150	110
Above Normal (16%)	76	116	136	151	128	94	78	58	100	129	135	117
Below Normal (13%)	92	134	148	158	104	85	61	52	85	146	137	94
Dry (24%)	86	103	124	143	104	83	44	36	55	107	68	75
Critical (15%)	53	78	106	105	79	50	30	26	30	46	63	56

Alternative 5

Statistic	Monthly Energy Use (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	106	174	154	153	146	153	59	68	128	155	132	106
20%	94	153	151	134	134	138	41	44	103	140	121	105
30%	85	140	142	120	116	109	35	40	86	122	113	102
40%	75	126	135	114	104	99	32	37	77	115	110	95
50%	72	106	128	110	94	75	30	33	65	105	102	90
60%	69	92	123	104	86	65	29	30	57	94	94	76
70%	63	74	115	95	71	61	24	22	46	88	80	70
80%	59	65	92	83	46	48	18	16	32	74	63	58
90%	54	56	68	71	32	22	13	12	24	50	49	47
Long Term												
Full Simulation Period ^b	76	110	121	109	92	86	33	36	71	103	95	82
Water Year Types^c												
Wet (32%)	81	129	131	125	124	123	50	58	113	132	119	93
Above Normal (16%)	75	112	122	100	90	104	35	40	84	100	107	86
Below Normal (13%)	76	122	132	107	90	77	28	30	62	106	100	96
Dry (24%)	74	101	121	108	77	64	23	21	43	96	71	74
Critical (15%)	69	73	86	88	54	30	13	13	22	56	64	56

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Energy Use (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-23%	16%	-5%	-12%	-20%	6%	-29%	-25%	12%	-4%	-27%	-3%
20%	-22%	9%	-5%	-20%	-10%	8%	-49%	-32%	-1%	-10%	-22%	-2%
30%	-27%	1%	-10%	-27%	-19%	8%	-56%	-32%	-10%	-16%	-15%	-4%
40%	-21%	-6%	-13%	-30%	-25%	23%	-57%	-32%	-16%	-18%	-14%	-10%
50%	-3%	-15%	-16%	-31%	-30%	9%	-56%	-31%	-26%	-20%	-17%	-14%
60%	4%	-16%	-15%	-34%	-26%	-3%	-51%	-33%	-26%	-21%	-14%	-15%
70%	11%	-23%	-9%	-37%	-15%	-3%	-52%	-41%	-29%	-10%	-7%	-14%
80%	28%	-19%	-17%	-33%	-16%	-8%	-49%	-44%	-26%	-13%	0%	-16%
90%	60%	-16%	-21%	-13%	17%	-26%	-41%	-49%	-8%	17%	27%	-4%
Long Term												
Full Simulation Period ^b	-10%	-4%	-11%	-27%	-20%	2%	-46%	-29%	-8%	-13%	-16%	-11%
Water Year Types^c												
Wet (32%)	-19%	-2%	-16%	-26%	-11%	30%	-36%	-15%	10%	-9%	-20%	-16%
Above Normal (16%)	0%	-4%	-10%	-34%	-30%	11%	-55%	-31%	-16%	-23%	-21%	-26%
Below Normal (13%)	-17%	-9%	-11%	-32%	-14%	-9%	-54%	-43%	-27%	-28%	-27%	3%
Dry (24%)	-13%	-2%	-2%	-25%	-26%	-23%	-48%	-42%	-21%	-10%	5%	-2%
Critical (15%)	29%	-6%	-18%	-16%	-31%	-40%	-56%	-48%	-26%	21%	1%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

5C.3.3.19 CVP Net Energy Use

Table 5C.3.3.19.1 CVP Net Generation, Monthly Net Generation

No Action Alternative

Statistic	Monthly Net Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	324	257	523	556	567	564	449	560	543	664	474	528
20%	283	220	218	372	491	444	355	513	500	624	446	491
30%	249	195	116	257	358	262	325	468	476	596	427	366
40%	216	162	72	147	163	169	304	441	452	558	418	344
50%	200	112	49	104	110	150	285	424	438	537	405	246
60%	154	96	42	71	94	133	270	404	426	508	381	198
70%	134	71	30	50	71	109	248	383	410	480	366	183
80%	119	56	18	37	54	95	225	327	377	450	347	150
90%	86	40	-1	24	36	72	198	262	332	400	302	104
Long Term												
Full Simulation Period ^b	197	145	139	209	230	243	307	420	443	530	393	295
Water Year Types^c												
Wet (32%)	236	193	311	433	389	435	397	522	455	551	423	504
Above Normal (16%)	193	143	136	223	363	263	334	443	459	608	419	334
Below Normal (13%)	231	137	43	79	181	144	288	422	478	573	423	198
Dry (24%)	178	128	34	74	67	119	233	376	469	518	391	174
Critical (15%)	118	76	34	48	59	104	221	249	323	380	276	89

Alternative 1

Statistic	Monthly Net Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	285	162	524	558	567	562	404	561	600	638	480	291
20%	239	132	272	412	486	482	324	519	577	622	463	256
30%	195	103	114	288	296	288	297	481	531	602	438	227
40%	173	87	72	135	208	188	273	461	517	579	422	217
50%	162	81	43	78	114	155	255	444	488	547	405	205
60%	152	75	33	30	74	132	238	413	469	518	393	189
70%	138	58	24	18	53	108	214	384	454	493	369	179
80%	106	50	12	6	20	86	194	343	407	463	356	155
90%	92	32	-10	-8	-7	65	162	292	363	398	321	98
Long Term												
Full Simulation Period ^b	172	100	142	187	215	251	274	431	491	537	401	213
Water Year Types^c												
Wet (32%)	197	138	336	414	382	455	351	517	533	552	423	289
Above Normal (16%)	169	99	109	211	351	302	263	456	517	611	436	224
Below Normal (13%)	189	87	40	73	176	161	262	444	527	577	438	212
Dry (24%)	158	80	34	35	46	98	219	397	487	530	395	176
Critical (15%)	126	67	28	30	28	90	223	261	346	395	294	98

Alternative 1 minus No Action Alternative

Statistic	Monthly Net Generation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-12%	-37%	0%	0%	0%	0%	-10%	0%	11%	-4%	1%	-45%
20%	-16%	-40%	25%	11%	-1%	9%	-9%	1%	15%	0%	4%	-48%
30%	-22%	-47%	-1%	12%	-17%	10%	-9%	3%	11%	1%	3%	-38%
40%	-20%	-46%	0%	-8%	28%	11%	-10%	4%	14%	4%	1%	-37%
50%	-19%	-28%	-12%	-25%	4%	3%	-10%	5%	11%	2%	0%	-17%
60%	-2%	-22%	-22%	-57%	-22%	-1%	-12%	2%	10%	2%	3%	-5%
70%	3%	-17%	-19%	-64%	-26%	-1%	-14%	0%	11%	3%	1%	-2%
80%	-11%	-10%	-32%	-84%	-63%	-10%	-14%	5%	8%	3%	2%	3%
90%	7%	-19%	1388%	-134%	-120%	-10%	-18%	11%	9%	0%	6%	-5%
Long Term												
Full Simulation Period ^b	-13%	-31%	2%	-10%	-6%	3%	-11%	2%	11%	1%	2%	-28%
Water Year Types^c												
Wet (32%)	-16%	-29%	8%	-5%	-2%	5%	-12%	-1%	17%	0%	0%	-43%
Above Normal (16%)	-12%	-31%	-20%	-5%	-3%	15%	-21%	3%	13%	0%	4%	-33%
Below Normal (13%)	-18%	-36%	-7%	-8%	-3%	12%	-9%	5%	10%	1%	4%	7%
Dry (24%)	-11%	-38%	0%	-52%	-32%	-18%	-6%	6%	4%	2%	1%	1%
Critical (15%)	7%	-12%	-18%	-38%	-53%	-14%	1%	5%	7%	4%	6%	11%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.19.2 CVP Net Generation, Monthly Net Generation

Second Basis of Comparison

Statistic	Monthly Net Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	285	162	524	558	567	562	404	561	600	638	480	291
20%	239	132	272	412	486	482	324	519	577	622	463	256
30%	195	103	114	288	296	288	297	481	531	602	438	227
40%	173	87	72	135	208	188	273	461	517	579	422	217
50%	162	81	43	78	114	155	255	444	488	547	405	205
60%	152	75	33	30	74	132	238	413	469	518	393	189
70%	138	58	24	18	53	108	214	384	454	493	369	179
80%	106	50	12	6	20	86	194	343	407	463	356	155
90%	92	32	-10	-8	-7	65	162	292	363	398	321	98
Long Term												
Full Simulation Period ^b	172	100	142	187	215	251	274	431	491	537	401	213
Water Year Types^c												
Wet (32%)	197	138	336	414	382	455	351	517	533	552	423	289
Above Normal (16%)	169	99	109	211	351	302	263	456	517	611	436	224
Below Normal (13%)	189	87	40	73	176	161	262	444	527	577	438	212
Dry (24%)	158	80	34	35	46	98	219	397	487	530	395	176
Critical (15%)	126	67	28	30	28	90	223	261	346	395	294	98

No Action Alternative

Statistic	Monthly Net Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	324	257	523	556	567	564	449	560	543	664	474	528
20%	283	220	218	372	491	444	355	513	500	624	446	491
30%	249	195	116	257	358	262	325	468	476	596	427	366
40%	216	162	72	147	163	169	304	441	452	558	418	344
50%	200	112	49	104	110	150	285	424	438	537	405	246
60%	154	96	42	71	94	133	270	404	426	508	381	198
70%	134	71	30	50	71	109	248	383	410	480	366	183
80%	119	56	18	37	54	95	225	327	377	450	347	150
90%	86	40	-1	24	36	72	198	262	332	400	302	104
Long Term												
Full Simulation Period ^b	197	145	139	209	230	243	307	420	443	530	393	295
Water Year Types^c												
Wet (32%)	236	193	311	433	389	435	397	522	455	551	423	504
Above Normal (16%)	193	143	136	223	363	263	334	443	459	608	419	334
Below Normal (13%)	231	137	43	79	181	144	288	422	478	573	423	198
Dry (24%)	178	128	34	74	67	119	233	376	469	518	391	174
Critical (15%)	118	76	34	48	59	104	221	249	323	380	276	89

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Net Generation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	14%	59%	0%	0%	0%	0%	11%	0%	-10%	4%	-1%	81%
20%	18%	66%	-20%	-10%	1%	-8%	10%	-1%	-13%	0%	-4%	92%
30%	27%	90%	1%	-11%	21%	-9%	10%	-3%	-10%	-1%	-2%	61%
40%	25%	86%	0%	8%	-22%	-10%	12%	-4%	-13%	-4%	-1%	58%
50%	24%	39%	14%	34%	-3%	-3%	12%	-4%	-10%	-2%	0%	20%
60%	2%	29%	29%	134%	27%	1%	13%	-2%	-9%	-2%	-3%	5%
70%	-3%	21%	24%	176%	34%	1%	16%	0%	-10%	-3%	-1%	2%
80%	12%	12%	47%	513%	167%	11%	16%	-4%	-7%	-3%	-2%	-3%
90%	-7%	24%	-93%	-394%	-606%	11%	22%	-10%	-9%	0%	-6%	6%
Long Term												
Full Simulation Period ^b	15%	44%	-2%	11%	7%	-3%	12%	-2%	-10%	-1%	-2%	38%
Water Year Types^c												
Wet (32%)	19%	40%	-8%	5%	2%	-4%	13%	1%	-15%	0%	0%	74%
Above Normal (16%)	14%	44%	25%	5%	3%	-13%	27%	-3%	-11%	0%	-4%	49%
Below Normal (13%)	22%	57%	8%	9%	3%	-11%	10%	-5%	-9%	-1%	-3%	-7%
Dry (24%)	13%	61%	0%	110%	47%	22%	7%	-5%	-4%	-2%	-1%	-1%
Critical (15%)	-6%	14%	22%	62%	111%	16%	-1%	-5%	-7%	-4%	-6%	-10%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.19.3 CVP Net Generation, Monthly Net Generation

Second Basis of Comparison

Statistic	Monthly Net Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	285	162	524	558	567	562	404	561	600	638	480	291
20%	239	132	272	412	486	482	324	519	577	622	463	256
30%	195	103	114	288	296	288	297	481	531	602	438	227
40%	173	87	72	135	208	188	273	461	517	579	422	217
50%	162	81	43	78	114	155	255	444	488	547	405	205
60%	152	75	33	30	74	132	238	413	469	518	393	189
70%	138	58	24	18	53	108	214	384	454	493	369	179
80%	106	50	12	6	20	86	194	343	407	463	356	155
90%	92	32	-10	-8	-7	65	162	292	363	398	321	98
Long Term												
Full Simulation Period ^b	172	100	142	187	215	251	274	431	491	537	401	213
Water Year Types^c												
Wet (32%)	197	138	336	414	382	455	351	517	533	552	423	289
Above Normal (16%)	169	99	109	211	351	302	263	456	517	611	436	224
Below Normal (13%)	189	87	40	73	176	161	262	444	527	577	438	212
Dry (24%)	158	80	34	35	46	98	219	397	487	530	395	176
Critical (15%)	126	67	28	30	28	90	223	261	346	395	294	98

Alternative 3

Statistic	Monthly Net Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	291	182	530	558	606	583	437	534	563	674	481	336
20%	235	125	266	480	511	511	316	479	531	638	465	266
30%	193	104	114	332	334	287	298	459	508	622	441	246
40%	173	91	74	160	183	189	268	439	473	596	424	216
50%	158	77	52	112	122	150	251	392	448	544	409	205
60%	147	66	39	72	84	122	229	374	433	528	387	195
70%	133	60	25	51	71	106	216	348	411	506	374	181
80%	113	52	12	36	56	92	200	316	387	469	362	155
90%	88	31	-6	18	41	71	174	260	340	397	326	104
Long Term												
Full Simulation Period ^b	172	102	150	224	241	250	275	400	457	549	406	217
Water Year Types^c												
Wet (32%)	197	137	349	456	402	443	347	475	467	572	436	294
Above Normal (16%)	166	109	123	257	381	276	269	408	475	621	429	230
Below Normal (13%)	190	81	42	117	198	167	276	418	493	588	440	221
Dry (24%)	160	81	36	67	71	115	217	372	478	537	396	177
Critical (15%)	125	73	35	45	60	108	223	260	346	402	305	101

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Net Generation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2%	13%	1%	0%	7%	4%	8%	-5%	-6%	6%	0%	15%
20%	-2%	-5%	-2%	16%	5%	6%	-2%	-8%	-8%	3%	0%	4%
30%	-1%	2%	0%	16%	13%	-1%	1%	-5%	-4%	3%	1%	8%
40%	0%	5%	2%	18%	-12%	1%	-2%	-5%	-8%	3%	1%	-1%
50%	-3%	-4%	19%	44%	7%	-3%	-2%	-12%	-8%	-1%	1%	0%
60%	-3%	-12%	18%	138%	13%	-7%	-4%	-9%	-8%	2%	-2%	3%
70%	-4%	2%	3%	181%	36%	-3%	1%	-9%	-10%	3%	1%	1%
80%	6%	4%	-5%	490%	174%	7%	3%	-8%	-5%	1%	2%	0%
90%	-4%	-3%	-44%	-317%	-682%	10%	7%	-11%	-6%	0%	2%	6%
Long Term												
Full Simulation Period ^b	0%	2%	6%	20%	12%	0%	0%	-7%	-7%	2%	1%	2%
Water Year Types^c												
Wet (32%)	0%	0%	4%	10%	5%	-3%	-1%	-8%	-12%	4%	3%	2%
Above Normal (16%)	-2%	10%	13%	22%	9%	-9%	2%	-10%	-8%	2%	-2%	3%
Below Normal (13%)	1%	-7%	7%	61%	13%	3%	6%	-6%	-6%	2%	0%	4%
Dry (24%)	1%	1%	6%	89%	54%	18%	-1%	-6%	-2%	1%	0%	1%
Critical (15%)	-1%	9%	24%	51%	113%	21%	0%	0%	0%	2%	4%	3%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5C.3.3.19.4 CVP Net Generation, Monthly Net Generation

Second Basis of Comparison

Statistic	Monthly Net Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	285	162	524	558	567	562	404	561	600	638	480	291
20%	239	132	272	412	486	482	324	519	577	622	463	256
30%	195	103	114	288	296	288	297	481	531	602	438	227
40%	173	87	72	135	208	188	273	461	517	579	422	217
50%	162	81	43	78	114	155	255	444	488	547	405	205
60%	152	75	33	30	74	132	238	413	469	518	393	189
70%	138	58	24	18	53	108	214	384	454	493	369	179
80%	106	50	12	6	20	86	194	343	407	463	356	155
90%	92	32	-10	-8	-7	65	162	292	363	398	321	98
Long Term												
Full Simulation Period ^b	172	100	142	187	215	251	274	431	491	537	401	213
Water Year Types^c												
Wet (32%)	197	138	336	414	382	455	351	517	533	552	423	289
Above Normal (16%)	169	99	109	211	351	302	263	456	517	611	436	224
Below Normal (13%)	189	87	40	73	176	161	262	444	527	577	438	212
Dry (24%)	158	80	34	35	46	98	219	397	487	530	395	176
Critical (15%)	126	67	28	30	28	90	223	261	346	395	294	98

Alternative 5

Statistic	Monthly Net Generation (GWh)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	323	255	511	557	567	559	451	559	528	654	468	527
20%	285	219	219	356	495	444	360	514	496	620	442	495
30%	233	186	113	253	363	270	330	469	475	589	426	365
40%	217	160	72	146	159	168	310	447	450	551	415	343
50%	194	116	48	104	107	148	294	426	437	531	402	243
60%	158	99	39	72	92	131	274	409	424	509	377	199
70%	134	71	28	52	67	105	254	389	404	485	366	177
80%	110	57	18	38	52	84	237	323	368	425	346	146
90%	84	31	-2	25	35	72	210	288	322	396	304	107
Long Term												
Full Simulation Period ^b	197	144	137	208	229	242	315	427	438	524	390	296
Water Year Types^c												
Wet (32%)	233	191	307	433	388	431	397	527	454	553	419	506
Above Normal (16%)	190	142	136	221	364	264	335	449	458	608	416	333
Below Normal (13%)	230	135	42	79	175	144	305	428	471	569	420	198
Dry (24%)	179	130	32	75	67	119	250	383	461	508	388	173
Critical (15%)	123	76	34	47	56	102	237	257	314	358	273	97

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Net Generation (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	13%	58%	-3%	0%	0%	0%	12%	0%	-12%	3%	-2%	81%
20%	19%	65%	-20%	-14%	2%	-8%	11%	-1%	-14%	0%	-4%	94%
30%	19%	81%	-1%	-12%	23%	-6%	11%	-3%	-10%	-2%	-3%	60%
40%	25%	83%	-1%	8%	-23%	-11%	14%	-3%	-13%	-5%	-2%	58%
50%	20%	44%	10%	33%	-6%	-5%	15%	-4%	-10%	-3%	-1%	19%
60%	4%	32%	19%	138%	24%	0%	15%	-1%	-9%	-2%	-4%	5%
70%	-3%	21%	14%	182%	27%	-3%	19%	1%	-11%	-2%	-1%	-1%
80%	3%	14%	46%	522%	159%	-2%	23%	-6%	-10%	-8%	-3%	-6%
90%	-8%	-4%	-82%	-404%	-603%	10%	29%	-1%	-11%	0%	-5%	9%
Long Term												
Full Simulation Period ^b	14%	44%	-3%	11%	6%	-4%	15%	-1%	-11%	-2%	-3%	39%
Water Year Types^c												
Wet (32%)	18%	39%	-9%	5%	2%	-5%	13%	2%	-15%	0%	-1%	75%
Above Normal (16%)	12%	44%	25%	4%	4%	-13%	27%	-1%	-11%	-1%	-5%	48%
Below Normal (13%)	22%	55%	5%	8%	0%	-11%	17%	-4%	-11%	-1%	-4%	-7%
Dry (24%)	14%	63%	-6%	113%	47%	22%	14%	-4%	-5%	-4%	-2%	-1%
Critical (15%)	-3%	14%	21%	57%	99%	14%	6%	-1%	-9%	-9%	-7%	-1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

5C.3.3.20 Stanislaus River Percent Mortality – Fall-run Chinook Salmon

Table 5C.3.3.20 Stanislaus River Percent Mortality - Fall-Run Chinook Salmon

	Percent Mortality	Difference from No Action Alternative	Difference from Second Basis of Comparison
	%	%	%
No Action Alternative			
Long-term Average	7.0	---	-0.4
Wet	1.6	---	0.1
Above Normal	5.3	---	-0.1
Below Normal	4.4	---	0.3
Dry	4.9	---	-0.3
Critical	14.4	---	-1.5
Second Basis of Comparison			
Long-term Average	7.4	0.4	
Wet	1.5	-0.1	---
Above Normal	5.4	0.1	---
Below Normal	4.1	-0.3	---
Dry	5.1	0.3	---
Critical	15.9	1.5	---
Alternative 3			
Long-term Average	6.2	-0.8	-1.2
Wet	1.6	0.0	0.1
Above Normal	4.0	-1.3	-1.4
Below Normal	3.8	-0.6	-0.3
Dry	4.2	-0.7	-0.9
Critical	13.4	-1.0	-2.5
Alternative 5			
Long-term Average	8.5	1.5	1.0
Wet	1.8	0.2	0.3
Above Normal	6.4	1.1	1.0
Below Normal	6.1	1.6	2.0
Dry	7.0	2.2	1.9
Critical	16.9	2.5	1.0

Notes: All results are based on the 82-year simulation period. The water year types are defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

5C.3.3.21 New Melones Large Mouth Bass Nest Survival Percentage

Table 5C.3.3.21.1 New Melones Large Mouth Bass Nest Survival Percentage, Monthly Percentage

No Action Alternative

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	66	38	80
20%	100	100	100	100	100	100	100	100	100	49	30	64
30%	84	100	100	100	100	100	100	100	100	31	25	59
40%	74	100	100	100	100	100	100	100	100	25	23	57
50%	67	100	100	100	100	100	80	100	98	22	20	55
60%	59	100	100	100	100	100	72	100	63	18	19	50
70%	50	100	100	100	100	100	49	40	42	13	16	43
80%	43	100	100	100	100	100	27	29	27	10	12	38
90%	29	100	100	100	100	100	13	14	15	1	4	34
Long Term												
Full Simulation Period ^b	66	99	100	100	97	95	68	72	69	29	23	54
Water Year Types^c												
Wet (23%)	67	100	100	100	96	94	83	98	95	47	24	51
Above Normal (24%)	74	100	100	100	100	100	88	100	72	26	20	60
Below Normal (10%)	60	100	100	100	98	95	58	65	61	22	19	58
Dry (16%)	63	99	100	100	97	98	66	51	54	14	16	49
Critical (27%)	65	97	100	100	93	87	29	25	43	28	37	58

Alternative 1

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	61	34	81
20%	100	100	100	100	100	100	100	100	100	43	30	64
30%	100	100	100	100	100	100	100	100	100	31	26	60
40%	100	100	100	100	100	100	100	100	100	27	24	56
50%	100	100	100	100	100	100	100	100	68	24	21	55
60%	100	100	100	100	100	100	98	100	51	21	18	49
70%	100	100	100	100	100	100	81	33	32	17	14	45
80%	91	100	100	100	100	100	52	21	25	12	10	39
90%	80	98	100	100	100	100	40	9	16	5	5	31
Long Term												
Full Simulation Period ^b	95	98	100	100	96	97	82	69	64	29	22	54
Water Year Types^c												
Wet (23%)	98	100	100	100	96	97	92	98	82	45	24	51
Above Normal (24%)	95	98	100	100	100	100	95	100	69	25	20	59
Below Normal (10%)	93	100	100	100	98	100	79	63	55	25	19	56
Dry (16%)	91	98	100	100	95	98	84	46	54	15	16	51
Critical (27%)	93	96	100	100	94	87	44	19	43	24	30	61

Alternative 1 minus No Action Alternative

Statistic	Monthly Percentage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-8%	-9%	1%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-14%	1%	0%
30%	19%	0%	0%	0%	0%	0%	0%	0%	0%	-2%	3%	1%
40%	35%	0%	0%	0%	0%	0%	0%	0%	0%	6%	5%	0%
50%	48%	0%	0%	0%	0%	0%	26%	0%	-30%	5%	3%	0%
60%	70%	0%	0%	0%	0%	0%	37%	0%	-20%	15%	-4%	0%
70%	99%	0%	0%	0%	0%	0%	64%	-18%	-22%	34%	-16%	4%
80%	113%	0%	0%	0%	0%	0%	95%	-27%	-9%	16%	-17%	2%
90%	180%	-2%	0%	0%	0%	0%	219%	-36%	8%	302%	48%	-9%
Long Term												
Full Simulation Period ^b	44%	-1%	0%	0%	0%	2%	20%	-3%	-8%	-1%	-5%	1%
Water Year Types^c												
Wet (23%)	48%	0%	0%	0%	0%	4%	11%	0%	-13%	-4%	-1%	-2%
Above Normal (24%)	29%	-1%	0%	0%	0%	0%	9%	0%	-5%	-4%	-2%	-2%
Below Normal (10%)	55%	0%	0%	0%	0%	5%	36%	-4%	-9%	15%	-4%	-2%
Dry (16%)	44%	-1%	0%	0%	-2%	0%	28%	-9%	0%	12%	2%	3%
Critical (27%)	44%	-2%	0%	0%	0%	0%	53%	-23%	0%	-12%	-18%	7%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.3.2.1.2 New Melones Large Mouth Bass Nest Survival Percentage, Monthly Percentage

Second Basis of Comparison

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	61	34	81
20%	100	100	100	100	100	100	100	100	100	43	30	64
30%	100	100	100	100	100	100	100	100	100	31	26	60
40%	100	100	100	100	100	100	100	100	100	27	24	56
50%	100	100	100	100	100	100	100	100	68	24	21	55
60%	100	100	100	100	100	100	98	100	51	21	18	49
70%	100	100	100	100	100	100	81	33	32	17	14	45
80%	91	100	100	100	100	100	52	21	25	12	10	39
90%	80	98	100	100	100	100	40	9	16	5	5	31
Long Term												
Full Simulation Period ^b	95	98	100	100	96	97	82	69	64	29	22	54
Water Year Types^c												
Wet (23%)	98	100	100	100	96	97	92	98	82	45	24	51
Above Normal (24%)	95	98	100	100	100	100	95	100	69	25	20	59
Below Normal (10%)	93	100	100	100	98	100	79	63	55	25	19	56
Dry (16%)	91	98	100	100	95	98	84	46	54	15	16	51
Critical (27%)	93	96	100	100	94	87	44	19	43	24	30	61

No Action Alternative

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	66	38	80
20%	100	100	100	100	100	100	100	100	100	49	30	64
30%	84	100	100	100	100	100	100	100	100	31	25	59
40%	74	100	100	100	100	100	100	100	100	25	23	57
50%	67	100	100	100	100	100	80	100	98	22	20	55
60%	59	100	100	100	100	100	72	100	63	18	19	50
70%	50	100	100	100	100	100	49	40	42	13	16	43
80%	43	100	100	100	100	100	27	29	27	10	12	38
90%	29	100	100	100	100	100	13	14	15	1	4	34
Long Term												
Full Simulation Period ^b	66	99	100	100	97	95	68	72	69	29	23	54
Water Year Types^c												
Wet (23%)	67	100	100	100	96	94	83	98	95	47	24	51
Above Normal (24%)	74	100	100	100	100	100	88	100	72	26	20	60
Below Normal (10%)	60	100	100	100	98	95	58	65	61	22	19	58
Dry (16%)	63	99	100	100	97	98	66	51	54	14	16	49
Critical (27%)	65	97	100	100	93	87	29	25	43	28	37	58

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Percentage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	8%	10%	-1%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	16%	-1%	0%
30%	-16%	0%	0%	0%	0%	0%	0%	0%	0%	2%	-3%	-1%
40%	-26%	0%	0%	0%	0%	0%	0%	0%	0%	-5%	-5%	0%
50%	-33%	0%	0%	0%	0%	0%	-20%	0%	44%	-5%	-3%	0%
60%	-41%	0%	0%	0%	0%	0%	-27%	0%	25%	-13%	4%	0%
70%	-50%	0%	0%	0%	0%	0%	-39%	22%	29%	-25%	19%	-4%
80%	-53%	0%	0%	0%	0%	0%	-49%	37%	10%	-14%	21%	-1%
90%	-64%	2%	0%	0%	0%	0%	-69%	56%	-7%	-75%	-32%	10%
Long Term												
Full Simulation Period ^b	-31%	1%	0%	0%	0%	-2%	-17%	3%	8%	1%	5%	-1%
Water Year Types^c												
Wet (23%)	-32%	0%	0%	0%	0%	-3%	-10%	0%	16%	4%	1%	2%
Above Normal (24%)	-22%	1%	0%	0%	0%	0%	-8%	0%	5%	4%	2%	2%
Below Normal (10%)	-35%	0%	0%	0%	0%	-5%	-26%	4%	10%	-13%	4%	2%
Dry (16%)	-31%	1%	0%	0%	2%	0%	-22%	10%	0%	-11%	-2%	-3%
Critical (27%)	-31%	2%	0%	0%	0%	0%	-35%	30%	0%	13%	21%	-6%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.3.21.3 New Melones Large Mouth Bass Nest Survival Percentage, Monthly Percentage

Second Basis of Comparison

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	61	34	81
20%	100	100	100	100	100	100	100	100	100	43	30	64
30%	100	100	100	100	100	100	100	100	100	31	26	60
40%	100	100	100	100	100	100	100	100	100	27	24	56
50%	100	100	100	100	100	100	100	100	68	24	21	55
60%	100	100	100	100	100	100	98	100	51	21	18	49
70%	100	100	100	100	100	100	81	33	32	17	14	45
80%	91	100	100	100	100	100	52	21	25	12	10	39
90%	80	98	100	100	100	100	40	9	16	5	5	31
Long Term												
Full Simulation Period ^b	95	98	100	100	96	97	82	69	64	29	22	54
Water Year Types^c												
Wet (23%)	98	100	100	100	96	97	92	98	82	45	24	51
Above Normal (24%)	95	98	100	100	100	100	95	100	69	25	20	59
Below Normal (10%)	93	100	100	100	98	100	79	63	55	25	19	56
Dry (16%)	91	98	100	100	95	98	84	46	54	15	16	51
Critical (27%)	93	96	100	100	94	87	44	19	43	24	30	61

Alternative 3

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	100	43	78
20%	100	100	100	100	100	100	100	100	100	57	37	69
30%	100	100	100	100	100	100	100	100	100	43	29	61
40%	100	100	100	100	100	100	100	100	100	31	27	56
50%	100	100	100	100	100	100	97	100	100	24	23	55
60%	100	100	100	100	100	100	75	92	55	21	20	48
70%	100	100	100	100	100	100	57	44	35	18	18	42
80%	94	100	100	100	100	100	43	21	28	11	11	31
90%	84	100	100	100	100	100	23	0	14	0	0	23
Long Term												
Full Simulation Period ^b	95	99	99	100	99	96	73	70	67	35	24	51
Water Year Types^c												
Wet (23%)	99	100	100	100	96	98	92	91	77	66	30	53
Above Normal (24%)	98	99	100	100	100	100	94	100	90	34	22	58
Below Normal (10%)	96	100	91	100	100	100	62	73	64	23	18	56
Dry (16%)	89	100	100	100	100	98	68	46	59	16	20	42
Critical (27%)	94	97	100	100	100	83	30	30	40	15	25	50

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Percentage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	64%	27%	-3%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	34%	22%	8%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	39%	14%	3%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	18%	13%	0%
50%	0%	0%	0%	0%	0%	0%	-3%	0%	47%	1%	9%	0%
60%	0%	0%	0%	0%	0%	0%	-23%	-8%	8%	-2%	11%	-3%
70%	0%	0%	0%	0%	0%	0%	-29%	34%	8%	4%	32%	-6%
80%	3%	0%	0%	0%	0%	0%	-18%	-4%	11%	-2%	9%	-19%
90%	5%	2%	0%	0%	0%	0%	-43%	-96%	-14%	-100%	-99%	-24%
Long Term												
Full Simulation Period ^b	0%	1%	-1%	0%	3%	0%	-10%	1%	6%	22%	11%	-6%
Water Year Types^c												
Wet (23%)	0%	0%	0%	0%	0%	0%	0%	-7%	-6%	45%	25%	5%
Above Normal (24%)	3%	1%	0%	0%	0%	0%	-1%	0%	31%	38%	10%	-1%
Below Normal (10%)	3%	0%	-9%	0%	2%	0%	-21%	15%	15%	-10%	-2%	0%
Dry (16%)	-3%	2%	0%	0%	5%	0%	-20%	1%	8%	2%	21%	-17%
Critical (27%)	1%	1%	0%	0%	7%	-4%	-31%	56%	-5%	-37%	-16%	-18%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.3.21.4 New Melones Large Mouth Bass Nest Survival Percentage, Monthly Percentage

Second Basis of Comparison

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	61	34	81
20%	100	100	100	100	100	100	100	100	100	43	30	64
30%	100	100	100	100	100	100	100	100	100	31	26	60
40%	100	100	100	100	100	100	100	100	100	27	24	56
50%	100	100	100	100	100	100	100	100	68	24	21	55
60%	100	100	100	100	100	100	98	100	51	21	18	49
70%	100	100	100	100	100	100	81	33	32	17	14	45
80%	91	100	100	100	100	100	52	21	25	12	10	39
90%	80	98	100	100	100	100	40	9	16	5	5	31
Long Term												
Full Simulation Period ^b	95	98	100	100	96	97	82	69	64	29	22	54
Water Year Types^c												
Wet (23%)	98	100	100	100	96	97	92	98	82	45	24	51
Above Normal (24%)	95	98	100	100	100	100	95	100	69	25	20	59
Below Normal (10%)	93	100	100	100	98	100	79	63	55	25	19	56
Dry (16%)	91	98	100	100	95	98	84	46	54	15	16	51
Critical (27%)	93	96	100	100	94	87	44	19	43	24	30	61

Alternative 5

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	75	36	98
20%	100	100	100	100	100	100	100	100	100	42	24	62
30%	88	100	100	100	100	100	100	100	100	30	22	57
40%	75	100	100	100	100	100	100	100	100	23	20	55
50%	69	100	100	100	100	100	72	100	100	20	19	50
60%	57	100	100	100	100	100	43	60	79	16	16	44
70%	51	100	100	100	100	100	24	29	43	12	11	39
80%	46	100	100	100	100	100	10	1	25	5	5	35
90%	35	100	100	100	100	95	0	0	7	0	0	13
Long Term												
Full Simulation Period ^b	67	100	100	100	98	95	60	64	70	28	21	50
Water Year Types^c												
Wet (23%)	71	100	100	100	96	95	87	93	97	41	19	47
Above Normal (24%)	73	99	100	100	100	100	79	94	61	21	17	53
Below Normal (10%)	58	100	100	100	98	95	50	58	59	18	14	44
Dry (16%)	58	99	100	100	100	98	45	37	52	10	13	45
Critical (27%)	73	100	100	100	99	85	14	19	60	44	50	67

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Percentage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	22%	5%	21%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-2%	-20%	-3%
30%	-12%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	-15%	-4%
40%	-25%	0%	0%	0%	0%	0%	0%	0%	0%	-13%	-17%	-2%
50%	-31%	0%	0%	0%	0%	0%	-28%	0%	47%	-17%	-12%	-9%
60%	-43%	0%	0%	0%	0%	0%	-56%	-40%	56%	-24%	-8%	-11%
70%	-49%	0%	0%	0%	0%	0%	-70%	-11%	33%	-30%	-18%	-13%
80%	-50%	0%	0%	0%	0%	0%	-81%	-94%	0%	-61%	-46%	-9%
90%	-57%	2%	0%	0%	0%	-5%	-100%	-100%	-56%	-98%	-99%	-58%
Long Term												
Full Simulation Period ^b	-29%	1%	0%	0%	2%	-2%	-27%	-8%	9%	-5%	-2%	-8%
Water Year Types^c												
Wet (23%)	-28%	0%	0%	0%	0%	-3%	-5%	-5%	19%	-9%	-19%	-8%
Above Normal (24%)	-23%	1%	0%	0%	0%	0%	-17%	-6%	-12%	-16%	-14%	-10%
Below Normal (10%)	-38%	0%	0%	0%	0%	-5%	-37%	-8%	6%	-29%	-26%	-22%
Dry (16%)	-36%	1%	0%	0%	5%	0%	-47%	-19%	-3%	-35%	-23%	-11%
Critical (27%)	-21%	5%	0%	0%	5%	-1%	-69%	-1%	40%	82%	66%	9%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

5C.3.3.22 New Melones Small Mouth Bass Nest Survival Percentage

Table 5C.3.3.22.1 New Melones Small Mouth Bass Nest Survival Percentage, Monthly Percentage

No Action Alternative

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	56	32	67
20%	84	100	100	100	100	100	100	100	100	42	26	54
30%	71	100	100	100	100	100	100	100	100	27	22	50
40%	62	100	100	100	100	100	100	100	100	22	20	48
50%	57	100	100	100	100	100	67	100	86	20	18	46
60%	50	100	100	100	100	100	60	91	53	16	17	42
70%	43	100	100	100	100	100	42	34	35	12	15	37
80%	37	100	100	100	100	100	23	25	24	9	11	33
90%	25	100	100	100	100	85	12	13	14	2	4	29
Long Term												
Full Simulation Period ^b	58	98	100	100	96	94	65	70	66	26	21	47
Water Year Types^c												
Wet (23%)	59	100	100	100	96	93	81	97	93	42	21	43
Above Normal (24%)	64	98	100	100	100	100	86	99	68	22	18	52
Below Normal (10%)	54	100	100	100	97	94	55	63	59	19	17	50
Dry (16%)	55	97	100	100	97	98	59	48	50	12	15	43
Critical (27%)	58	95	100	99	92	82	26	23	40	25	36	53

Alternative 1

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	51	30	68
20%	100	100	100	100	100	100	100	100	100	36	26	54
30%	100	100	100	100	100	100	100	100	100	26	22	50
40%	100	100	100	100	100	100	100	100	100	23	21	48
50%	100	100	100	100	100	100	100	100	57	21	19	46
60%	92	100	100	100	100	100	82	96	43	18	16	42
70%	87	100	100	100	100	100	68	28	28	15	12	38
80%	76	91	100	100	100	100	44	19	22	11	9	33
90%	67	82	100	100	100	100	35	8	14	5	6	26
Long Term												
Full Simulation Period ^b	89	95	100	100	96	96	77	68	61	26	19	47
Water Year Types^c												
Wet (23%)	93	100	100	100	96	97	88	98	79	41	21	43
Above Normal (24%)	91	95	100	100	100	100	94	100	65	22	18	51
Below Normal (10%)	84	98	100	100	97	100	73	61	53	22	17	49
Dry (16%)	84	92	100	100	95	97	78	44	50	14	15	44
Critical (27%)	92	90	100	99	92	82	39	18	40	22	29	56

Alternative 1 minus No Action Alternative

Statistic	Monthly Percentage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-8%	-9%	1%
20%	19%	0%	0%	0%	0%	0%	0%	0%	0%	-13%	1%	0%
30%	42%	0%	0%	0%	0%	0%	0%	0%	0%	-2%	3%	1%
40%	61%	0%	0%	0%	0%	0%	0%	0%	0%	5%	5%	0%
50%	76%	0%	0%	0%	0%	0%	50%	0%	-34%	5%	3%	0%
60%	84%	0%	0%	0%	0%	0%	37%	6%	-20%	14%	-4%	0%
70%	104%	0%	0%	0%	0%	0%	63%	-18%	-22%	30%	-15%	4%
80%	109%	-9%	0%	0%	0%	0%	90%	-26%	-9%	14%	-15%	1%
90%	171%	-18%	0%	0%	0%	18%	196%	-33%	7%	136%	34%	-9%
Long Term												
Full Simulation Period ^b	54%	-3%	0%	0%	0%	2%	20%	-3%	-8%	-1%	-5%	1%
Water Year Types^c												
Wet (23%)	59%	0%	0%	0%	0%	4%	9%	0%	-15%	-3%	0%	-1%
Above Normal (24%)	41%	-2%	0%	0%	0%	0%	10%	0%	-4%	-4%	-2%	-2%
Below Normal (10%)	57%	-2%	0%	0%	0%	6%	34%	-3%	-10%	14%	-3%	-2%
Dry (16%)	52%	-5%	0%	0%	-2%	-1%	32%	-8%	0%	11%	2%	3%
Critical (27%)	58%	-5%	0%	0%	0%	0%	51%	-22%	1%	-11%	-19%	6%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.3.22.2 New Melones Small Mouth Bass Nest Survival Percentage, Monthly Percentage

Second Basis of Comparison

Statistic	Monthly Percentage (Percent Survival)												
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	100	100	100	100	100	100	100	100	100	100	51	30	68
20%	100	100	100	100	100	100	100	100	100	100	36	26	54
30%	100	100	100	100	100	100	100	100	100	100	26	22	50
40%	100	100	100	100	100	100	100	100	100	100	23	21	48
50%	100	100	100	100	100	100	100	100	100	57	21	19	46
60%	92	100	100	100	100	100	82	96	43	18	16	42	
70%	87	100	100	100	100	100	68	28	28	15	12	38	
80%	76	91	100	100	100	100	44	19	22	11	9	33	
90%	67	82	100	100	100	100	35	8	14	5	6	26	
Long Term													
Full Simulation Period ^b	89	95	100	100	96	96	77	68	61	26	19	47	
Water Year Types^c													
Wet (23%)	93	100	100	100	96	97	88	98	79	41	21	43	
Above Normal (24%)	91	95	100	100	100	100	94	100	65	22	18	51	
Below Normal (10%)	84	98	100	100	97	100	73	61	53	22	17	49	
Dry (16%)	84	92	100	100	95	97	78	44	50	14	15	44	
Critical (27%)	92	90	100	99	92	82	39	18	40	22	29	56	

No Action Alternative

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	56	32	67
20%	84	100	100	100	100	100	100	100	100	42	26	54
30%	71	100	100	100	100	100	100	100	100	27	22	50
40%	62	100	100	100	100	100	100	100	100	22	20	48
50%	57	100	100	100	100	100	67	100	86	20	18	46
60%	50	100	100	100	100	100	60	91	53	16	17	42
70%	43	100	100	100	100	100	42	34	35	12	15	37
80%	37	100	100	100	100	100	23	25	24	9	11	33
90%	25	100	100	100	100	85	12	13	14	2	4	29
Long Term												
Full Simulation Period ^b	58	98	100	100	96	94	65	70	66	26	21	47
Water Year Types^c												
Wet (23%)	59	100	100	100	96	93	81	97	93	42	21	43
Above Normal (24%)	64	98	100	100	100	100	86	99	68	22	18	52
Below Normal (10%)	54	100	100	100	97	94	55	63	59	19	17	50
Dry (16%)	55	97	100	100	97	98	59	48	50	12	15	43
Critical (27%)	58	95	100	99	92	82	26	23	40	25	36	53

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Percentage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	8%	10%	-1%
20%	-16%	0%	0%	0%	0%	0%	0%	0%	0%	16%	-1%	0%
30%	-29%	0%	0%	0%	0%	0%	0%	0%	0%	2%	-3%	-1%
40%	-38%	0%	0%	0%	0%	0%	0%	0%	0%	-5%	-5%	0%
50%	-43%	0%	0%	0%	0%	0%	-33%	0%	51%	-5%	-3%	0%
60%	-46%	0%	0%	0%	0%	0%	-27%	-5%	25%	-12%	4%	0%
70%	-51%	0%	0%	0%	0%	0%	-38%	21%	27%	-23%	17%	-3%
80%	-52%	10%	0%	0%	0%	0%	-47%	34%	10%	-12%	18%	-1%
90%	-63%	22%	0%	0%	0%	-15%	-66%	48%	-7%	-58%	-25%	10%
Long Term												
Full Simulation Period ^b	-35%	3%	0%	0%	0%	-2%	-17%	3%	9%	1%	6%	-1%
Water Year Types^c												
Wet (23%)	-37%	0%	0%	0%	0%	-4%	-9%	0%	17%	3%	0%	1%
Above Normal (24%)	-29%	2%	0%	0%	0%	0%	-9%	0%	4%	4%	2%	2%
Below Normal (10%)	-37%	2%	0%	0%	0%	-6%	-25%	3%	11%	-12%	3%	2%
Dry (16%)	-34%	5%	0%	0%	2%	1%	-24%	8%	0%	-10%	-2%	-3%
Critical (27%)	-37%	5%	0%	0%	0%	0%	-34%	28%	-1%	13%	24%	-6%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.3.22.3 New Melones Small Mouth Bass Nest Survival Percentage, Monthly Percentage

Second Basis of Comparison

Statistic	Monthly Percentage (Percent Survival)												
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	100	100	100	100	100	100	100	100	100	100	51	30	68
20%	100	100	100	100	100	100	100	100	100	100	36	26	54
30%	100	100	100	100	100	100	100	100	100	100	26	22	50
40%	100	100	100	100	100	100	100	100	100	100	23	21	48
50%	100	100	100	100	100	100	100	100	100	57	21	19	46
60%	92	100	100	100	100	100	82	96	43	18	16	42	
70%	87	100	100	100	100	100	68	28	28	15	12	38	
80%	76	91	100	100	100	100	44	19	22	11	9	33	
90%	67	82	100	100	100	100	35	8	14	5	6	26	
Long Term													
Full Simulation Period ^b	89	95	100	100	96	96	77	68	61	26	19	47	
Water Year Types^c													
Wet (23%)	93	100	100	100	96	97	88	98	79	41	21	43	
Above Normal (24%)	91	95	100	100	100	100	94	100	65	22	18	51	
Below Normal (10%)	84	98	100	100	97	100	73	61	53	22	17	49	
Dry (16%)	84	92	100	100	95	97	78	44	50	14	15	44	
Critical (27%)	92	90	100	99	92	82	39	18	40	22	29	56	

Alternative 3

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	100	37	66
20%	100	100	100	100	100	100	100	100	100	48	31	58
30%	100	100	100	100	100	100	100	100	100	36	25	52
40%	100	100	100	100	100	100	100	100	100	27	23	48
50%	99	100	100	100	100	100	81	100	100	21	20	46
60%	97	100	100	100	100	100	63	81	46	18	18	41
70%	84	100	100	100	100	100	48	38	30	16	16	36
80%	79	100	100	100	100	100	36	18	24	11	10	27
90%	70	88	100	100	100	100	20	0	13	0	0	20
Long Term												
Full Simulation Period ^b	90	98	99	100	99	96	70	69	65	32	21	44
Water Year Types^c												
Wet (23%)	94	100	100	100	96	98	89	90	77	62	26	45
Above Normal (24%)	93	98	100	100	100	100	93	100	88	30	19	50
Below Normal (10%)	90	100	91	100	100	100	57	69	61	20	16	49
Dry (16%)	81	96	100	100	100	97	62	44	54	14	18	37
Critical (27%)	90	92	100	100	99	79	27	27	37	13	23	44

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Percentage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	94%	26%	-3%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	33%	21%	7%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	37%	13%	2%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	17%	12%	0%
50%	-1%	0%	0%	0%	0%	0%	-19%	0%	74%	1%	9%	0%
60%	6%	0%	0%	0%	0%	0%	-23%	-16%	8%	-2%	11%	-3%
70%	-4%	0%	0%	0%	0%	0%	-29%	32%	8%	3%	29%	-6%
80%	3%	10%	0%	0%	0%	0%	-18%	-4%	11%	-2%	8%	-18%
90%	5%	8%	0%	0%	0%	0%	-42%	-95%	-12%	-91%	-97%	-23%
Long Term												
Full Simulation Period ^b	1%	2%	-1%	0%	3%	0%	-10%	1%	7%	25%	8%	-6%
Water Year Types^c												
Wet (23%)	1%	0%	0%	0%	0%	0%	1%	-7%	-3%	53%	24%	4%
Above Normal (24%)	3%	3%	0%	0%	0%	0%	-2%	0%	35%	37%	8%	-1%
Below Normal (10%)	7%	2%	-9%	0%	3%	0%	-23%	15%	16%	-10%	-3%	0%
Dry (16%)	-4%	4%	0%	0%	5%	0%	-20%	0%	7%	1%	19%	-16%
Critical (27%)	-2%	3%	0%	1%	8%	-4%	-30%	51%	-8%	-40%	-19%	-22%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.3.22.4 New Melones Small Mouth Bass Nest Survival Percentage, Monthly Percentage

Second Basis of Comparison

Statistic	Monthly Percentage (Percent Survival)												
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	100	100	100	100	100	100	100	100	100	100	51	30	68
20%	100	100	100	100	100	100	100	100	100	100	36	26	54
30%	100	100	100	100	100	100	100	100	100	100	26	22	50
40%	100	100	100	100	100	100	100	100	100	100	23	21	48
50%	100	100	100	100	100	100	100	100	100	57	21	19	46
60%	92	100	100	100	100	100	82	96	43	18	16	42	
70%	87	100	100	100	100	100	68	28	28	15	12	38	
80%	76	91	100	100	100	100	44	19	22	11	9	33	
90%	67	82	100	100	100	100	35	8	14	5	6	26	
Long Term													
Full Simulation Period ^b	89	95	100	100	96	96	77	68	61	26	19	47	
Water Year Types^c													
Wet (23%)	93	100	100	100	96	97	88	98	79	41	21	43	
Above Normal (24%)	91	95	100	100	100	100	94	100	65	22	18	51	
Below Normal (10%)	84	98	100	100	97	100	73	61	53	22	17	49	
Dry (16%)	84	92	100	100	95	97	78	44	50	14	15	44	
Critical (27%)	92	90	100	99	92	82	39	18	40	22	29	56	

Alternative 5

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	63	31	88
20%	87	100	100	100	100	100	100	100	100	36	21	53
30%	74	100	100	100	100	100	100	100	100	26	19	48
40%	63	100	100	100	100	100	100	100	100	20	17	47
50%	58	100	100	100	100	100	60	100	100	18	17	42
60%	48	100	100	100	100	100	37	51	66	14	15	37
70%	43	100	100	100	100	100	21	25	37	11	10	34
80%	39	100	100	100	100	100	9	2	22	5	6	30
90%	30	100	100	100	100	80	0	0	7	0	1	12
Long Term												
Full Simulation Period ^b	59	99	100	100	98	94	57	62	67	25	20	44
Water Year Types^c												
Wet (23%)	61	100	100	100	96	95	84	90	94	36	17	40
Above Normal (24%)	65	98	100	100	100	100	76	93	58	18	15	46
Below Normal (10%)	51	100	100	100	97	94	47	56	57	16	12	39
Dry (16%)	52	97	100	100	100	97	43	36	49	9	12	39
Critical (27%)	68	98	100	100	98	81	13	19	58	43	50	63

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Percentage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	22%	5%	29%
20%	-13%	0%	0%	0%	0%	0%	0%	0%	0%	-2%	-20%	-3%
30%	-26%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	-15%	-4%
40%	-37%	0%	0%	0%	0%	0%	0%	0%	0%	-12%	-16%	-2%
50%	-42%	0%	0%	0%	0%	0%	-40%	0%	74%	-16%	-11%	-8%
60%	-47%	0%	0%	0%	0%	0%	-56%	-48%	54%	-22%	-7%	-11%
70%	-51%	0%	0%	0%	0%	0%	-69%	-11%	32%	-28%	-17%	-12%
80%	-49%	10%	0%	0%	0%	0%	-79%	-88%	0%	-54%	-40%	-9%
90%	-56%	22%	0%	0%	0%	-20%	-100%	-100%	-51%	-96%	-78%	-55%
Long Term												
Full Simulation Period ^b	-34%	3%	0%	0%	2%	-2%	-26%	-9%	11%	-3%	0%	-7%
Water Year Types^c												
Wet (23%)	-34%	0%	0%	0%	0%	-3%	-5%	-7%	19%	-10%	-19%	-7%
Above Normal (24%)	-28%	2%	0%	0%	0%	0%	-19%	-7%	-11%	-16%	-13%	-9%
Below Normal (10%)	-39%	2%	0%	0%	0%	-6%	-37%	-7%	8%	-28%	-25%	-21%
Dry (16%)	-39%	5%	0%	0%	5%	0%	-45%	-19%	-3%	-34%	-22%	-11%
Critical (27%)	-26%	10%	0%	1%	6%	-1%	-67%	5%	45%	92%	72%	12%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

5C.3.3.23 New Melones Spotted Bass Nest Survival Percentage

Table 5C.3.3.23.1 New Melones Spotted Bass Nest Survival Percentage, Monthly Percentage

No Action Alternative

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	100	100	100
20%	100	100	100	100	100	100	100	100	100	100	91	100
30%	100	100	100	100	100	100	100	100	100	93	85	100
40%	100	100	100	100	100	100	100	100	100	85	81	100
50%	100	100	100	100	100	100	100	100	100	81	78	100
60%	100	100	100	100	100	100	100	100	100	75	76	100
70%	100	100	100	100	100	100	100	100	100	68	73	100
80%	100	100	100	100	100	100	87	91	88	64	66	100
90%	90	100	100	100	100	100	68	69	71	51	55	97
Long Term												
Full Simulation Period ^b	94	100	100	100	99	99	90	91	91	77	76	97
Water Year Types^c												
Wet (23%)	88	100	100	100	98	96	88	100	96	84	79	96
Above Normal (24%)	99	100	100	100	100	100	98	100	99	77	78	100
Below Normal (10%)	91	100	100	100	100	100	90	90	94	80	77	99
Dry (16%)	97	100	100	100	100	100	97	92	89	69	72	99
Critical (27%)	99	100	100	100	100	100	73	62	72	75	75	94

Alternative 1

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	100	98	100
20%	100	100	100	100	100	100	100	100	100	100	92	100
30%	100	100	100	100	100	100	100	100	100	93	86	100
40%	100	100	100	100	100	100	100	100	100	87	83	100
50%	100	100	100	100	100	100	100	100	100	83	79	100
60%	100	100	100	100	100	100	100	100	100	79	75	100
70%	100	100	100	100	100	100	100	96	95	74	69	100
80%	100	100	100	100	100	100	100	80	85	66	63	100
90%	100	100	100	100	100	100	100	62	72	57	57	93
Long Term												
Full Simulation Period ^b	100	100	100	100	98	100	98	89	92	80	77	98
Water Year Types^c												
Wet (23%)	100	100	100	100	97	100	100	100	99	93	83	96
Above Normal (24%)	100	100	100	100	100	100	100	100	96	78	77	100
Below Normal (10%)	100	100	100	100	100	100	100	90	92	84	76	99
Dry (16%)	100	100	100	100	97	100	100	87	90	71	73	99
Critical (27%)	98	100	100	100	100	100	87	56	78	62	71	96

Alternative 1 minus No Action Alternative

Statistic	Monthly Percentage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-2%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	1%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	2%	2%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	2%	1%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	5%	-1%	0%
70%	0%	0%	0%	0%	0%	0%	0%	-4%	-5%	9%	-5%	0%
80%	0%	0%	0%	0%	0%	0%	15%	-12%	-4%	4%	-4%	0%
90%	11%	0%	0%	0%	0%	0%	48%	-10%	2%	10%	4%	-5%
Long Term												
Full Simulation Period ^b	6%	0%	0%	0%	-1%	1%	9%	-2%	1%	3%	1%	0%
Water Year Types^c												
Wet (23%)	13%	0%	0%	0%	-1%	4%	13%	0%	3%	11%	6%	0%
Above Normal (24%)	1%	0%	0%	0%	0%	0%	2%	0%	-3%	1%	-1%	0%
Below Normal (10%)	10%	0%	0%	0%	0%	0%	11%	-1%	-2%	5%	-1%	0%
Dry (16%)	3%	0%	0%	0%	-3%	0%	3%	-5%	1%	3%	1%	0%
Critical (27%)	-1%	0%	0%	0%	0%	0%	20%	-10%	9%	-17%	-4%	2%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.3.23.2 New Melones Spotted Bass Nest Survival Percentage, Monthly Percentage

Second Basis of Comparison

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	100	98	100
20%	100	100	100	100	100	100	100	100	100	100	92	100
30%	100	100	100	100	100	100	100	100	100	93	86	100
40%	100	100	100	100	100	100	100	100	100	87	83	100
50%	100	100	100	100	100	100	100	100	100	83	79	100
60%	100	100	100	100	100	100	100	100	100	79	75	100
70%	100	100	100	100	100	100	100	96	95	74	69	100
80%	100	100	100	100	100	100	100	80	85	66	63	100
90%	100	100	100	100	100	100	100	62	72	57	57	93
Long Term												
Full Simulation Period ^b	100	100	100	100	98	100	98	89	92	80	77	98
Water Year Types^c												
Wet (23%)	100	100	100	100	97	100	100	100	99	93	83	96
Above Normal (24%)	100	100	100	100	100	100	100	100	96	78	77	100
Below Normal (10%)	100	100	100	100	100	100	100	90	92	84	76	99
Dry (16%)	100	100	100	100	97	100	100	87	90	71	73	99
Critical (27%)	98	100	100	100	100	100	87	56	78	62	71	96

No Action Alternative

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	100	100	100
20%	100	100	100	100	100	100	100	100	100	100	91	100
30%	100	100	100	100	100	100	100	100	100	93	85	100
40%	100	100	100	100	100	100	100	100	100	85	81	100
50%	100	100	100	100	100	100	100	100	100	81	78	100
60%	100	100	100	100	100	100	100	100	100	75	76	100
70%	100	100	100	100	100	100	100	100	100	68	73	100
80%	100	100	100	100	100	100	87	91	88	64	66	100
90%	90	100	100	100	100	100	68	69	71	51	55	97
Long Term												
Full Simulation Period ^b	94	100	100	100	99	99	90	91	91	77	76	97
Water Year Types^c												
Wet (23%)	88	100	100	100	98	96	88	100	96	84	79	96
Above Normal (24%)	99	100	100	100	100	100	98	100	99	77	78	100
Below Normal (10%)	91	100	100	100	100	100	90	90	94	80	77	99
Dry (16%)	97	100	100	100	100	100	97	92	89	69	72	99
Critical (27%)	99	100	100	100	100	100	73	62	72	75	75	94

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Percentage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	2%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	-1%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-2%	-2%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-2%	-1%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-5%	2%	0%
70%	0%	0%	0%	0%	0%	0%	0%	4%	5%	-8%	5%	0%
80%	0%	0%	0%	0%	0%	0%	-13%	14%	4%	-3%	5%	0%
90%	-10%	0%	0%	0%	0%	0%	-32%	11%	-2%	-9%	-4%	5%
Long Term												
Full Simulation Period ^b	-6%	0%	0%	0%	1%	-1%	-8%	2%	-1%	-3%	-1%	0%
Water Year Types^c												
Wet (23%)	-12%	0%	0%	0%	1%	-4%	-12%	0%	-3%	-10%	-5%	0%
Above Normal (24%)	-1%	0%	0%	0%	0%	0%	-2%	0%	3%	-1%	1%	0%
Below Normal (10%)	-9%	0%	0%	0%	0%	0%	-10%	1%	2%	-5%	1%	0%
Dry (16%)	-3%	0%	0%	0%	3%	0%	-3%	5%	-1%	-3%	-1%	0%
Critical (27%)	1%	0%	0%	0%	0%	0%	-17%	11%	-8%	21%	5%	-2%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.3.23.3 New Melones Spotted Bass Nest Survival Percentage, Monthly Percentage

Second Basis of Comparison

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	100	98	100
20%	100	100	100	100	100	100	100	100	100	100	92	100
30%	100	100	100	100	100	100	100	100	100	93	86	100
40%	100	100	100	100	100	100	100	100	100	87	83	100
50%	100	100	100	100	100	100	100	100	100	83	79	100
60%	100	100	100	100	100	100	100	100	100	79	75	100
70%	100	100	100	100	100	100	100	96	95	74	69	100
80%	100	100	100	100	100	100	100	80	85	66	63	100
90%	100	100	100	100	100	100	100	62	72	57	57	93
Long Term												
Full Simulation Period ^b	100	100	100	100	98	100	98	89	92	80	77	98
Water Year Types^c												
Wet (23%)	100	100	100	100	97	100	100	100	99	93	83	96
Above Normal (24%)	100	100	100	100	100	100	100	100	96	78	77	100
Below Normal (10%)	100	100	100	100	100	100	100	90	92	84	76	99
Dry (16%)	100	100	100	100	97	100	100	87	90	71	73	99
Critical (27%)	98	100	100	100	100	100	87	56	78	62	71	96

Alternative 3

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	100	100	100
20%	100	100	100	100	100	100	100	100	100	100	100	100
30%	100	100	100	100	100	100	100	100	100	100	91	100
40%	100	100	100	100	100	100	100	100	100	94	87	100
50%	100	100	100	100	100	100	100	100	100	83	82	100
60%	100	100	100	100	100	100	100	100	100	79	78	100
70%	100	100	100	100	100	100	100	100	98	75	75	100
80%	100	100	100	100	100	100	100	79	88	66	65	94
90%	100	100	100	100	100	100	82	38	69	48	38	82
Long Term												
Full Simulation Period ^b	100	100	99	100	99	99	94	86	88	78	75	91
Water Year Types^c												
Wet (23%)	100	100	100	100	98	100	100	92	77	98	87	98
Above Normal (24%)	100	100	100	100	100	100	100	100	99	80	68	92
Below Normal (10%)	100	100	91	100	100	100	90	95	97	69	66	98
Dry (16%)	100	100	100	100	100	100	93	73	93	67	74	79
Critical (27%)	100	100	100	100	100	92	79	71	83	63	70	89

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Percentage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	2%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	9%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	8%	6%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	8%	5%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	3%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	4%	0%
70%	0%	0%	0%	0%	0%	0%	0%	4%	3%	1%	9%	0%
80%	0%	0%	0%	0%	0%	0%	0%	-1%	5%	0%	2%	-6%
90%	0%	0%	0%	0%	0%	0%	-18%	-39%	-4%	-14%	-34%	-11%
Long Term												
Full Simulation Period ^b	0%	0%	-1%	0%	1%	-1%	-4%	-3%	-5%	-2%	-2%	-7%
Water Year Types^c												
Wet (23%)	0%	0%	0%	0%	1%	0%	0%	-8%	-22%	5%	5%	3%
Above Normal (24%)	0%	0%	0%	0%	0%	0%	0%	0%	3%	3%	-13%	-8%
Below Normal (10%)	0%	0%	-9%	0%	0%	0%	-10%	6%	5%	-18%	-12%	-1%
Dry (16%)	0%	0%	0%	0%	3%	0%	-7%	-15%	4%	-6%	2%	-21%
Critical (27%)	2%	0%	0%	0%	0%	-8%	-10%	26%	5%	1%	-3%	-7%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.3.23.4 New Melones Spotted Bass Nest Survival Percentage, Monthly Percentage

Second Basis of Comparison

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	100	98	100
20%	100	100	100	100	100	100	100	100	100	100	92	100
30%	100	100	100	100	100	100	100	100	100	93	86	100
40%	100	100	100	100	100	100	100	100	100	87	83	100
50%	100	100	100	100	100	100	100	100	100	83	79	100
60%	100	100	100	100	100	100	100	100	100	79	75	100
70%	100	100	100	100	100	100	100	96	95	74	69	100
80%	100	100	100	100	100	100	100	80	85	66	63	100
90%	100	100	100	100	100	100	100	62	72	57	57	93
Long Term												
Full Simulation Period ^b	100	100	100	100	98	100	98	89	92	80	77	98
Water Year Types^c												
Wet (23%)	100	100	100	100	97	100	100	100	99	93	83	96
Above Normal (24%)	100	100	100	100	100	100	100	100	96	78	77	100
Below Normal (10%)	100	100	100	100	100	100	100	90	92	84	76	99
Dry (16%)	100	100	100	100	97	100	100	87	90	71	73	99
Critical (27%)	98	100	100	100	100	100	87	56	78	62	71	96

Alternative 5

Statistic	Monthly Percentage (Percent Survival)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	100	100	100	100	100	100	100	100	100	100	99	100
20%	100	100	100	100	100	100	100	100	100	100	83	100
30%	100	100	100	100	100	100	100	100	100	92	80	100
40%	100	100	100	100	100	100	100	100	100	82	77	100
50%	100	100	100	100	100	100	100	100	100	78	76	100
60%	100	100	100	100	100	100	100	100	100	72	73	100
70%	100	100	100	100	100	100	84	91	100	67	65	100
80%	100	100	100	100	100	100	63	52	84	56	57	99
90%	98	100	100	100	100	100	27	9	60	33	50	68
Long Term												
Full Simulation Period ^b	96	100	100	100	99	100	81	80	88	72	71	91
Water Year Types^c												
Wet (23%)	99	100	100	100	97	99	99	100	100	90	76	94
Above Normal (24%)	99	100	100	100	100	100	90	100	76	66	74	92
Below Normal (10%)	87	100	100	100	100	100	78	74	92	65	65	79
Dry (16%)	93	100	100	100	100	100	78	71	85	56	59	93
Critical (27%)	97	100	100	100	100	100	38	38	80	73	80	92

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Percentage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	2%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-9%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%	-7%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-6%	-7%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-7%	-4%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-9%	-3%	0%
70%	0%	0%	0%	0%	0%	0%	-16%	-5%	5%	-10%	-5%	0%
80%	0%	0%	0%	0%	0%	0%	-37%	-35%	0%	-15%	-10%	-1%
90%	-2%	0%	0%	0%	0%	0%	-73%	-85%	-17%	-41%	-13%	-27%
Long Term												
Full Simulation Period ^b	-4%	0%	0%	0%	1%	0%	-18%	-10%	-4%	-9%	-8%	-7%
Water Year Types^c												
Wet (23%)	-1%	0%	0%	0%	-1%	-1%	-1%	0%	1%	-3%	-8%	-1%
Above Normal (24%)	-1%	0%	0%	0%	0%	0%	-10%	0%	-21%	-16%	-5%	-8%
Below Normal (10%)	-13%	0%	0%	0%	0%	0%	-22%	-18%	-1%	-22%	-15%	-20%
Dry (16%)	-7%	0%	0%	0%	3%	0%	-22%	-18%	-6%	-21%	-18%	-6%
Critical (27%)	-1%	0%	0%	0%	0%	0%	-57%	-31%	2%	18%	13%	-4%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5C.3.3.24 Temperature Threshold Exceedances

Species	Lifestage	River	Reach	Water Year Type	Month	Temperature Objective (Degree F)	Temperature Objective Reference ¹	No Action Alternative	Second Basis of Comparison (Alternative 1)	Alternative 3	Alternative 5	Alternative 1 minus No Action Alternative	No Action Alternative minus Second Basis of Comparison	Alternative 3 minus Second Basis of Comparison	Alternative 5 minus Second Basis of Comparison
Steelhead	Adult Migration	Stanislaus	Orange Blossom Bridge	All	October	56	NMFS BIOP 2009	57%	85%	87%	58%	28%	-28%	2%	-27%
Steelhead	Adult Migration	Stanislaus	Orange Blossom Bridge	All	November	56	NMFS BIOP 2009	33%	28%	24%	36%	-5%	5%	-4%	8%
Steelhead	Adult Migration	Stanislaus	Orange Blossom Bridge	All	December	56	NMFS BIOP 2009	0%	0%	0%	3%	0%	0%	0%	3%
Steelhead	Smoltification	Stanislaus	Knights Ferry (*Used Below Goodwin Dam)	All	January	52	NMFS BIOP 2009	0%	2%	2%	2%	2%	-2%	0%	0%
Steelhead	Smoltification	Stanislaus	Knights Ferry (*Used Below Goodwin Dam)	All	February	52	NMFS BIOP 2009	0%	2%	2%	0%	2%	-2%	0%	-2%
Steelhead	Smoltification	Stanislaus	Knights Ferry (*Used Below Goodwin Dam)	All	March	52	NMFS BIOP 2009	8%	9%	12%	8%	1%	-1%	3%	-1%
Steelhead	Smoltification	Stanislaus	Knights Ferry (*Used Below Goodwin Dam)	All	April	52	NMFS BIOP 2009	33%	31%	30%	37%	-2%	2%	-1%	6%
Steelhead	Smoltification	Stanislaus	Knights Ferry (*Used Below Goodwin Dam)	All	May	52	NMFS BIOP 2009	63%	66%	63%	68%	3%	-3%	-3%	2%
Steelhead	Smoltification	Stanislaus	Orange Blossom Bridge	All	January	57	NMFS BIOP 2009	0%	0%	0%	0%	0%	0%	0%	0%
Steelhead	Smoltification	Stanislaus	Orange Blossom Bridge	All	February	57	NMFS BIOP 2009	0%	0%	0%	0%	0%	0%	0%	0%
Steelhead	Smoltification	Stanislaus	Orange Blossom Bridge	All	March	57	NMFS BIOP 2009	0%	0%	0%	0%	0%	0%	0%	0%
Steelhead	Smoltification	Stanislaus	Orange Blossom Bridge	All	April	57	NMFS BIOP 2009	2%	8%	3%	0%	6%	-6%	-4%	-8%
Steelhead	Smoltification	Stanislaus	Orange Blossom Bridge	All	May	57	NMFS BIOP 2009	18%	10%	17%	8%	-8%	8%	7%	-3%
Steelhead	Spawning	Stanislaus	Orange Blossom Bridge	All	January	55	NMFS BIOP 2009	0%	0%	0%	0%	0%	0%	0%	0%
Steelhead	Spawning	Stanislaus	Orange Blossom Bridge	All	February	55	NMFS BIOP 2009	0%	0%	1%	0%	0%	0%	1%	0%
Steelhead	Spawning	Stanislaus	Orange Blossom Bridge	All	March	55	NMFS BIOP 2009	21%	16%	25%	21%	-5%	5%	8%	4%
Steelhead	Spawning	Stanislaus	Orange Blossom Bridge	All	April	55	NMFS BIOP 2009	16%	34%	17%	7%	17%	-17%	-16%	-26%
Steelhead	Spawning	Stanislaus	Orange Blossom Bridge	All	May	55	NMFS BIOP 2009	49%	43%	53%	40%	-5%	5%	10%	-3%
Steelhead	Rearing	Stanislaus	Orange Blossom Bridge	All	June	65	NMFS BIOP 2009	6%	2%	4%	6%	-3%	3%	2%	3%
Steelhead	Rearing	Stanislaus	Orange Blossom Bridge	All	July	65	NMFS BIOP 2009	16%	16%	19%	21%	-1%	1%	4%	6%
Steelhead	Rearing	Stanislaus	Orange Blossom Bridge	All	August	65	NMFS BIOP 2009	15%	13%	9%	21%	-2%	2%	-4%	8%
Steelhead	Rearing	Stanislaus	Orange Blossom Bridge	All	September	65	NMFS BIOP 2009	11%	10%	7%	18%	0%	0%	-3%	8%
Steelhead	Rearing	Stanislaus	Orange Blossom Bridge	All	October	65	NMFS BIOP 2009	7%	8%	4%	11%	1%	-1%	-4%	3%
Steelhead	Rearing	Stanislaus	Orange Blossom Bridge	All	November	65	NMFS BIOP 2009	0%	0%	0%	0%	0%	0%	0%	0%

¹See Appendix 9N, Section C for the full reference

Table 5C.3.3.25 CVP Annual Power Generation Summary

				No Action Alternative	Second Basis of Comparison (Alternative 1)	Alternative 3	Alternative 5	Alternative 1 vs. No Action Alternative (Percent Difference)	No Action Alternative vs. Second Basis of Comparison (Percent Difference)	Alternative 3 vs. Second Basis of Comparison (Percent Difference)	Alternative 5 vs. Second Basis of Comparison (Percent Difference)
CVP Generation Facilities											
Capacity	At load center	(MW)	Long Term	1,583	1,633	1,642	1,568	3%	-3%	1%	-4%
			Dry and Critical	1,203	1,277	1,291	1,173	6%	-6%	1%	-8%
Energy Generation	Total of all Facilities at load center	(GWh)	Long Term	4,558	4,604	4,582	4,552	1%	-1%	0%	-1%
			Dry and Critical	2,696	2,773	2,798	2,684	3%	-3%	1%	-3%
CVP Pumping Facilities											
Energy Use	Total of all Facilities at load center	(GWh)	Long Term	1,113	1,289	1,238	1,110	16%	-14%	-4%	-14%
			Dry and Critical	699	773	715	699	11%	-10%	-8%	-10%
All CVP Facilities											
Net Generation	Total of all Facilities	(GWh)	Long Term	3,445	3,315	3,344	3,442	-4%	4%	1%	4%
			Dry and Critical	1,997	2,000	2,084	1,986	0%	0%	4%	-1%

Notes: 1) Long-term Average is the average quantity for the 82-year simulation period. 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030. 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in text. 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in text.

This page left blank intentionally.

1 **Appendix 5D**

2 **Municipal and Industrial Water**
3 **Demands and Supplies**

4 **5D.1 Introduction**

5 Most water supply agencies in California that serve more than 3,000 connections
6 or more than 3,000 acre-feet of water prepare Urban Water Management Plans
7 (UWMPs) for submittal to the California Department of Water Resources. The
8 UWMPs include water demand and water supply projections through at least
9 2030. The future water demands include assumptions for implementation of
10 water conservation measures to meet the statewide mandate to reduce municipal
11 and industrial (M&I) water demand by 20 percent by 2020.

12 Information from the UWMPs for Central Valley Project (CVP) and State Water
13 Project (SWP) water users was used as input information in the CWEST model
14 (see Appendix 19A, CWEST Model) to project M&I water supply economic
15 changes. For small water users that did not prepare a UWMP, information was
16 obtained from water master plans and integrated regional water management
17 plans. This information is summarized in the following sections of this appendix.
18 The tabular format is consistent for each water user and was established to be
19 consistent with the input files for the CWEST model; therefore, there are rows in
20 the tabular format that are not used for some M&I water users.

21 **5D.2 Central Valley Region**

22 This section includes summaries of water demand and water supply projections
23 for M&I users of CVP and SWP water supplies in the Central Valley Region,
24 including water rights users on the Sacramento and American rivers. The M&I
25 water users are generally organized geographically in this section from north to
26 south. See Tables 5D.1 through 5D.31.

1 **Table 5D.1 Bella Vista Water District (BVWD)**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	14,567	BVWD serves portions of Redding. Assumed growth rate from City of Redding <i>2010 Urban Water Management Plan</i> .
Water Sales to Others	–	–
Total Demand	14,567	–
Water Supplies for No Action Alternative (NAA)		
CVP Water Supplies	14,445	CVP Water Service Contract 24,578 acre-feet, includes 24,000 acre-feet (14-06-200-851A-LTR1) and 578 acre-feet assigned from Shasta County Water Agency initial CVP Water Service Contract (14-06-200-3464A-LTR1).
SWP Water Supplies	–	–
Other Imported Water Supplies	–	–
Local Surface Water Supplies	–	–
Groundwater	122	Assumed no increase in wells.
Recycled Wastewater	–	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	14,567	–
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	–	–
Total Potential Future Water Supplies	–	–

1 **Table 5D.2 Centerville Community Services District**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	3,185	–
Water Sales to Others	–	–
Total Demand	3,185	–
Water Supplies for NAA		
CVP Water Supplies	3,185	CVP Water Exchange Contract 900 acre-feet (pre-1914 water right on Clear Creek) and CVP Water Service Contract 2,900 acre-feet, (14-06-200-3367A-LTR1).
SWP Water Supplies	–	–
Other Imported Water Supplies	–	–
Local Surface Water Supplies	–	–
Groundwater	–	–
Recycled Wastewater	–	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	3,185	–
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	–	–
Total Potential Future Water Supplies	–	–
Other Information	–	Sanitary Survey states that 25% of 35-mgd Water Treatment Plant is owned by Centerville Community Services District (Redding Area Water Suppliers. 2011. <i>Redding Area Watershed Sanitary Survey</i>).

2 Note:
3 mgd = million gallons per day

1 **Table 5D.3 City of Shasta Lake**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	2,455	City of Shasta Lake. 2014. 2010 Urban Water Management Plan, Administrative Draft. July.
Water Sales to Others	470	–
Total Demand	2,925	–
Water Supplies for NAA		
CVP Water Supplies	2,885	CVP Water Exchange Contract 900 acre-feet (pre-1914 water right on Clear Creek) and CVP Water Service Contract 2,900 acre-feet, (14-06-200-3367A-LTR1).
SWP Water Supplies	–	–
Other Imported Water Supplies	–	–
Local Surface Water Supplies	–	–
Groundwater	–	–
Recycled Wastewater	112	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	2,997	
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	–	–
Other Information	–	Supplies do not include transfers not approved by Reclamation due to cold water pool issues: Anderson-Cottonwood Irrigation District 2,000 acre-feet, MCM Properties at 325 acre-feet. Future project would develop facilities that would allow these transfers and result in 2,325 acre-feet normal year and 2,093 acre-feet in 3rd multiple dry years per 2010 UWMP (with reference to support from Reclamation).
Total Potential Future Water Supplies	2,997	–

1 **Table 5D.4 Clear Creek Community Services District (CCCSD)**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	7,410	CCCSD serves areas near Redding. Assumed growth rate from City of Redding <i>2010 Urban Water Management Plan</i> .
Water Sales to Others	–	–
Total Demand	7,410	–
Water Supplies for NAA		
CVP Water Supplies	7,410	CVP Water Service Contract 15,300 acre-feet, (14-06-200-4894A-LTR1).
SWP Water Supplies	–	–
Other Imported Water Supplies	–	–
Local Surface Water Supplies	–	–
Groundwater	–	–
Recycled Wastewater	–	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	7,410	–
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	–	–
Total Potential Future Water Supplies	–	–
Other Information	–	Sanitary Survey states that 25% of 35-mgd Water Treatment Plant is owned by Centerville Community Services District (Redding Area Water Suppliers. 2011. <i>Redding Area Watershed Sanitary Survey</i>).

1 **Table 5D.5 City of Redding**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	27,852	City of Redding. 2012. <i>2010 Urban Water Management Plan</i> . July 17.
Water Sales to Others	–	–
Total Demand	27,852	–
Water Supplies for NAA		
CVP Water Supplies	27,140	CVP Sacramento River Settlement Contract 21,000 acre-feet. CVP Water Service Contract (Buckeye Zone) 6,140 acre-feet (14-06-200-5272A-LTR1).
SWP Water Supplies	–	–
Other Imported Water Supplies	–	–
Local Surface Water Supplies	–	–
Groundwater	13,405	Increased supply from new wells.
Recycled Wastewater	19	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	40,564	–
Possible Future Water Supplies	–	Not quantified. Historical transfers up to 4,000 acre-feet (3,000 acre-feet during drought) from Anderson-Cottonwood Irrigation District.
Subtotal Possible Future Water Supplies	–	–
Total Potential Future Water Supplies	–	–

1 **Table 5D.6 Mountain Gate Community Services District**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	2,180	Assume full use of CVP water supplies.
Water Sales to Others	–	–
Total Demand	2,180	
Water Supplies for NAA		
CVP Water Supplies	1,350	Assume full use of CVP water supplies.
SWP Water Supplies	–	–
Other Imported Water Supplies	–	–
Local Surface Water Supplies	–	–
Groundwater	830	Assume no increase in wells.
Recycled Wastewater	–	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	2,180	–
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	–	–
Total Potential Future Water Supplies	2,180	–

1 **Table 5D.7 Shasta Community Services District**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	1,000	Assume full use of CVP water supplies.
Water Sales to Others	–	–
Total Demand	1,000	–
Water Supplies for NAA		
CVP Water Supplies	1,000	Assume full use of CVP water supplies.
SWP Water Supplies	–	–
Other Imported Water Supplies	–	–
Local Surface Water Supplies	–	–
Groundwater	–	–
Recycled Wastewater	–	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	1,000	
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	–	–
Total Potential Future Water Supplies	1,000	–

1 **Table 5D.8 Shasta County Water Agency**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	1,022	Assume full use of CVP water supplies.
Water Sales to Others	-	-
Total Demand	1,022	-
Water Supplies for NAA		
CVP Water Supplies	1,022	Assume full use of CVP water supplies.
SWP Water Supplies	-	-
Other Imported Water Supplies	-	-
Local Surface Water Supplies	-	-
Groundwater	-	-
Recycled Wastewater	-	-
Recycled Stormwater	-	-
Desalination	-	-
Transfers/Exchanges	-	-
Conservation	-	-
Total Water Supplies for NAA	1,022	-
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	-	-
Total Potential Future Water Supplies	1,022	-

1 **Table 5D.9 City of Yuba City**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	29,041	Yuba City. 2011. <i>2010 Urban Water Management Plan, Public Review Document</i> . June.
Water Sales to Others	-	-
Total Demand	29,041	-
Water Supplies for NAA		
CVP Water Supplies	-	-
SWP Water Supplies	8,000	SWP Contract 9,600 acre-feet. Long-term average based on Department of Water Resources. 2013. <i>Final Initial Study/Negative Declaration State Water Project Supply Allocation Settlement Agreement</i> . September.
Other Imported Water Supplies	-	-
Local Surface Water Supplies	15,500	Up to 6,500 acre-feet State Water Resources Control Board (SWRCB) Permit 14045. Up to 9,000 acre-feet SWRCB Permit 18558.
Groundwater	3,248	In the future, a second well could be constructed for 4 mgd; assume 4,500 acre-feet based on same production as existing well.
Recycled Wastewater	-	Reclamation use is limited to 140 acre-feet of landscape irrigation at the Wastewater Treatment Facility.
Recycled Stormwater	-	-
Desalination	-	-
Transfers/Exchanges	4,500	Up to 4,500 acre-feet from North Yuba Water District.
Conservation	-	-
Total Water Supplies for NAA	31,248	-
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	-	-
Total Potential Future Water Supplies	31,248	-

1 **Table 5D.10 City of West Sacramento**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	20,123	City of West Sacramento. 2011. <i>2010 Urban Water Management Plan, Public Review Document</i> . October.
Water Sales to Others	–	–
Total Demand	20,123	
Water Supplies for NAA		
CVP Water Supplies	–	–
SWP Water Supplies	23,600	CVP Sacramento River Settlement Contract 23,600 acre-feet (0-07-20-W0187) in accordance with Appropriative Water Right on Sacramento River (State Water Resources Control Board Permit Number 18150).
Other Imported Water Supplies	–	–
Local Surface Water Supplies	5,000	5,000 acre-feet as part of North Delta Water Agency water rights, in accordance with agreements with the State of California.
Groundwater	–	–
Recycled Wastewater	–	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	28,600	–
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	–	–
Total Potential Future Water Supplies	28,600	–

1 **Table 5D.11 El Dorado County Water Agency**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	12,054	11,741 acre-feet for Georgetown Divide Public Utility District and 313 acre-feet for Grizzly Flats Community Service District (including County areas) per El Dorado County Water Agency. 2014. <i>Water Resources Development & Management Plan (December 2007) 2014 West Slope Update, Final Draft.</i> October. Includes agricultural expansion for trees, vines, and pasture. Remaining areas of community development within El Dorado Irrigation District (EID).
Water Sales to Others	-	-
Total Demand	12,054	-
Water Supplies for NAA		
CVP Water Supplies	-	-
SWP Water Supplies	-	-
Other Imported Water Supplies	-	-
Local Surface Water Supplies	12,200	12,200 acre-feet from Stumpy Meadows Reservoir on Pilot Creek per Georgetown Divide Public Utility District. 2011. <i>2010 Urban Water Management Plan.</i> July 22.
Groundwater	150	150 acre-feet for Grizzly Flats Community Service District per El Dorado County Water Agency. 2014. <i>Water Resources Development & Management Plan (December 2007) 2014 West Slope Update, Final Draft.</i> October.
Recycled Wastewater	-	-
Recycled Stormwater	-	-
Desalination	-	-
Transfers/Exchanges	-	-
Conservation	-	-
Total Water Supplies for NAA	12,350	-

Appendix 5D: Municipal and Industrial Water Demands and Supplies

Items	Water Demand and Supplies (acre-feet)	Notes
Possible Future Water Supplies	–	<p>9,000 acre-feet of the 15,000-acre-foot CVP water service contract authorized by Public Law 101-514 (also known as “Fazio Water”) for Georgetown Divide Public Utility District per El Dorado County Water Agency. 2014. <i>Water Resources Development & Management Plan (December 2007) 2014 West Slope Update, Final Draft</i>. October. Assumed that 6,000 acre-feet would be used by EID.</p> <p>150 acre-feet from a new reservoir (not planned) per El Dorado County Water Agency. 2014. <i>Water Resources Development & Management Plan (December 2007) 2014 West Slope Update, Final Draft</i>. October.</p> <p>670 acre-feet from lining canals in Georgetown Divide Public Utilities District per El Dorado County Water Agency. 2014. <i>Water Resources Development & Management Plan (December 2007) 2014 West Slope Update, Final Draft</i>. October.</p> <p>40,000 acre-feet from water rights applications State Water Resources Control Board Filed Applications Nos. 5644 and 5645 for storage of water from Sacramento Municipal Utility District (SMUD) Upper American River Project and diversion at Folsom Lake with an exchange with an upstream water rights holder. To be shared with EID. Per El Dorado County Water Agency. 2014. <i>Water Resources Development & Management Plan (December 2007) 2014 West Slope Update, Final Draft</i>. October.</p> <p>10,300 acre-feet from diversion of water from South Fork of the Rubicon River with a negotiation under the El Dorado-SMUD Cooperation Agreement per El Dorado County Water Agency. 2014. <i>Water Resources Development & Management Plan (December 2007) 2014 West Slope Update, Final Draft</i>. October.</p> <p>1,000 acre-feet from dry year conservation efforts per El Dorado County Water Agency. 2014. <i>Water Resources Development & Management Plan (December 2007) 2014 West Slope Update, Final Draft</i>. October.</p>

Appendix 5D: Municipal and Industrial Water Demands and Supplies

Items	Water Demand and Supplies (acre-feet)	Notes
Subtotal Possible Future Water Supplies	9,000	All future projects not included for M&I No Action Alternative assumptions since some of the future projects are not fully defined or analyzed.
Total Potential Future Water Supplies	21,350	It is assumed that not all future projects would be implemented. Therefore, total potential future water supplies would be substantially less.

1 **Table 5D.12 El Dorado Irrigation District**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	55,709	Per El Dorado Irrigation District. 2011. <i>Urban Water Management Plan, 2010 Update</i> . July.
Water Sales to Others	1,330	–
Total Demand	57,039	–
Water Supplies for NAA		
CVP Water Supplies	7,550	CVP Water Service Contract (C 14-06-200-1357A-LTR1) 7,550 acre-feet diverted from Folsom Lake for portion of El Dorado Hills per El Dorado Irrigation District. 2011. <i>Urban Water Management Plan, 2010 Update</i> . July.
SWP Water Supplies	–	–
Other Imported Water Supplies	–	–
Local Surface Water Supplies	59,640	<p>23,000 acre-feet from Jenkinson Lake on Park Creek (actually 33,400 acre-foot water right L11835 and L11836, with restriction of 23,000 acre-feet/two years).</p> <p>4,560 acre-feet from Weber Creek (Farmer’s Free Ditch) and Reservoir, Slab Creek (Summerfield Ditch), and Hangtown Creek (Gold Hill Ditch) diverted from Folsom Lake using a 40-year Warren Act Contract (signed March 1, 2011).</p> <p>17,000 acre-foot El Dorado Hydroelectric Project 184 at Folsom Lake under State Water Resources Control Board Permit 21112.</p> <p>15,080 acre-feet from Project 184 at El Dorado Forebay pre-1914 water rights.</p> <p>El Dorado Irrigation District. 2011. <i>Urban Water Management Plan, 2010 Update</i>. July; and El Dorado Irrigation District. 2012. <i>United States Bureau of Reclamation Five-Year Water Management Plan, 2010 Update</i>. July.</p> <p>El Dorado Irrigation District (EID) acquired Project 184 from Pacific Gas & Electric Company in 1999 with water rights from the South Fork American River and conveyed in the El Dorado Canal to El Dorado Forebay and Jenkinson Lake; however, needs a Warren Act Contract to divert at Folsom Reservoir.</p>

Appendix 5D: Municipal and Industrial Water Demands and Supplies

Items	Water Demand and Supplies (acre-feet)	Notes
Local Surface Water Supplies (continued)		Jenkinson Lake supply could be reduced from 23,000 to 20,920 acre-feet per El Dorado Irrigation District. 2013. <i>2013 Water Resources and Service Reliability Report</i> August 12.
Groundwater	–	–
Recycled Wastewater	3,804	3,804 acre-feet per El Dorado Irrigation District. 2011. <i>Urban Water Management Plan, 2010 Update</i> . July.
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	70,994	–
Possible Future Water Supplies	47,500	Up to 40,000 acre-feet under the Sacramento Municipal Utility District (SMUD)-El Dorado Agreement from SMUD reservoirs per El Dorado Irrigation District. 2011. <i>Urban Water Management Plan, 2010 Update</i> . July. 7,500 acre-feet of the 15,000-acre-foot CVP water service contract authorized by Public Law 101-514 (also known as “Fazio Water”) per El Dorado Irrigation District. 2011. <i>Urban Water Management Plan, 2010 Update</i> . July. However, the available supply may only be 6,000 acre-feet per El Dorado County Water Agency. 2014. <i>Water Resources Development & Management Plan (December 2007) 2014 West Slope Update, Final Draft</i> . October.
Subtotal Possible Future Water Supplies	47,500	–
Total Potential Future Water Supplies	118,494	–

1 **Table 5D.13 City of Folsom**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	36,259	City of Folsom. 2011. <i>2010 Urban Water Management Plan</i> . June.
Water Sales to Others	–	–
Total Demand	36,259	–
Water Supplies for NAA		
CVP Water Supplies	7,000	7,000 acre-foot Water Service Contract (C 6-07-20-W1372) under Public Law 101-514 (Fazio Water).
SWP Water Supplies	–	–
Other Imported Water Supplies	–	–
Local Surface Water Supplies	28,540	22,000 acre-feet pre-1914 water right diverted from South Fork American River at Folsom Lake and Folsom Canal. 5,000 acre-feet pre-1914 diverted from South Fork American River at Folsom Lake and Folsom Canal. 1,540 acre-feet from American River at Folsom Lake purchased from San Juan Water District for use in the Ashland Service Area.
Groundwater	3,250	Groundwater extraction and treatment produced by Aerojet groundwater cleanup process.
Recycled Wastewater	–	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	38,790	–
Possible Future Water Supplies	8,000	8,000 acre-feet purchase water from Natomas Central Mutual Water Company Sacramento Settlement Contract (14-06-200-885A) to be diverted at Freeport on the Sacramento River and conveyance to Folsom South area in accordance with the City of Folsom-Sacramento County Water Agency Memorandum of Agreement.
Subtotal Possible Future Water Supplies	8,000	–
Total Potential Future Water Supplies	46,790	–

1 **Table 5D.14 Placer County Water Agency**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	109,130	46,701 acre-feet domestic and 62,429 acre-feet irrigation per Placer County Water Agency. 2011. <i>2010 Urban Water Management Plan</i> . June 16.
Water Sales to Others	109,871	29,805 acre-foot sale of treated water to Lincoln, Cal-Am Water Company, and others. 79,411 acre-foot sale of untreated water to San Juan Water District, Roseville, and Sacramento Suburban Water District. 571 acre-foot sale of untreated water to Alpine Meadows Water Association, Dutch Flt Water, Heather Glen Community Services District, Meadow Vista County Water District, and Weimar Water Company.
Total Demand	219,001	–
Water Supplies for NAA		
CVP Water Supplies	35,000	35,000 acre-foot CVP Water Service Contract (14-06-200-5082A) diverted from the American River upstream of and from Folsom Lake.
SWP Water Supplies	–	–
Other Imported Water Supplies	–	–
Local Surface Water Supplies	248,800	125,400 af purchase from Pacific Gas & Electric Company under two pre-1914 water rights on the Yuba and Bear rivers. 120,000 acre-foot water right on the American River for the Middle Fork Project diverted from the American River upstream of and from Folsom Lake. Used by San Juan Water District, Sacramento Suburban Water District, Rio Linda/Elverta Community Water District, and Roseville. 12,000 acre-foot purchase from South Sutter Water District (SSWD) is only available when SSWD purchases surplus water from Nevada Irrigation District and not considered part of long-term supplies. Assumed average of 3,400 acre-feet/year from four pre-1914 appropriative water rights on Canyon Creek, tributary to Auburn Ravine, South Fork Dry Creek tributary to Coon Creek, and North Fork Dry Creek tributary to Coon Creek.
Groundwater	707	Limited groundwater available in Martis Valley Basin.

Appendix 5D: Municipal and Industrial Water Demands and Supplies

Items	Water Demand and Supplies (acre-feet)	Notes
Recycled Wastewater	6,987	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	291,494	–
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	–	–
Total Potential Future Water Supplies	291,494	–

1 **Table 5D.15 City of Roseville**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	49,334	City of Roseville. 2011. <i>2010 Urban Water Management Plan</i> . August.
Water Sales to Others	-	-
Total Demand	49,334	-
Water Supplies for NAA		
CVP Water Supplies	32,000	CVP Water Service Contract (14-06-200-3474A).
SWP Water Supplies	-	-
Other Imported Water Supplies	-	-
Local Surface Water Supplies	-	-
Groundwater	-	-
Recycled Wastewater	3,397	-
Recycled Stormwater	-	-
Desalination	-	-
Transfers/Exchanges	34,000	30,000 acre-foot purchase from Placer County Water Agency. 4,000 acre-foot purchase from San Juan Water District.
Conservation	-	-
Total Water Supplies for NAA	69,397	-
Possible Future Water Supplies	-	Under Water Forum Agreement, can transfer up to 20,000 acre-feet from Placer County Water Agency. Also may be able to purchase up to 7,000 acre-feet from other CVP water users. Up to 23,200 acre-feet from new wells.
Subtotal Possible Future Water Supplies	-	All future projects not included for M&I No Action Alternative assumptions since some of the future projects are not fully defined or analyzed.
Total Potential Future Water Supplies	69,397	Future water supplies used when existing water supplies not fully available.

1 **Table 5D.16 Sacramento County Water Agency**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	68,976	Sacramento County Water Agency. 2011. <i>2010 Zone 41 Urban Water Management Plan</i> . July.
Water Sales to Others	8,560	Sales to Elk Grove Water Service and Cal-Am Water Company.
Total Demand	77,535	–
Water Supplies for NAA		
CVP Water Supplies	40,000	15,000 acre-foot CVP Water Service Contract authorized by Public Law 101-514 (Fazio Water). Assume 12,320 acre-feet for long-time average based on capacity of conveyance. 30,000 acre-foot CVP Water Service Contract assigned from Sacramento Municipal Utility District (14-06-200-5198A) to Sacramento County Water Agency under two assignments.
SWP Water Supplies	–	–
Other Imported Water Supplies	–	–
Local Surface Water Supplies	17,500	Up to 71,000 acre-feet intermittent water from American and Sacramento rivers water rights under State Water Resources Control Board Permit 21209. Use 17,500 acre-feet for long-term average.
Groundwater	38,500	31,000 acre-feet from wells and 7,500 acre-feet from groundwater treatment processes.
Recycled Wastewater	4,400	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	14,498	14,498 acre-foot purchase from City of Sacramento in accordance with the Water Forum Agreement.
Conservation	–	–
Total Water Supplies for NAA	114,898	–
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	–	–
Total Potential Future Water Supplies	114,898	–

1 **Table 5D.17 Sacramento Suburban Water District**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	40,389	Sacramento Suburban Water District. 2011. <i>2010 Urban Water Management Plan</i> . July.
Water Sales to Others	1,800	1,700 acre-feet sold to Cal-Am Water Company and 100 acre-feet to Rio Linda/Elverta Community Water District.
Total Demand	43,189	–
Water Supplies for NAA		
CVP Water Supplies	1,000	NOT CVP WATER SUPPLY. Surplus Section 215 water. Assume 12,000 acre-feet in wet years and long-term average of 1,000 acre-feet.
SWP Water Supplies	–	–
Other Imported Water Supplies	–	–
Local Surface Water Supplies	–	–
Groundwater	31,241	–
Recycled Wastewater	–	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	21,300	12,000-29,000 acre-feet purchased from Placer County Water Agency, diverted from Folsom Lake, and treated by San Juan Water District in wet years. 9,300 acre-feet purchased from City of Sacramento.
Conservation	–	–
Total Water Supplies for NAA	53,541	–
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	–	–
Total Potential Future Water Supplies	53,541	–

1 **Table 5D.18 San Juan Water District**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	55,657	San Juan Water District. 2011. <i>2010 Urban Water Management Plan</i> . June 22. Includes 38,591 acre-feet purchased for conjunctive use which is not required each year.
Water Sales to Others	44,199	18,765 acre-feet to Citrus Heights Water District. 14,894 acre-feet to Fair Oaks Water District. 5,000 acre-feet to Orange Vale Water Company. 1,540 acre-feet to Folsom. 4,000 acre-feet to Roseville.
Total Demand	99,856	61,265 acre-feet without conjunctive use component.
Water Supplies for NAA		
CVP Water Supplies	24,200	11,200 acre-foot CVP Water Service Contract (06-07-20-W1373). 13,000 acre-foot CVP Water Service Contracts diverted from Folsom Lake as authorized under Public Law 101-514 (Fazio Water) (06-07-20-W1373).
SWP Water Supplies	–	–
Other Imported Water Supplies	–	–
Local Surface Water Supplies	33,000	33,000 acre-feet pre-1914 water rights.
Groundwater	–	–
Recycled Wastewater	–	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	25,000	25,000 acre-foot purchase from Placer County Water Agency.
Conservation	–	–
Total Water Supplies for NAA	82,200	–
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	–	–
Total Potential Future Water Supplies	82,200	–

1 **Table 5D.19 Golden State Water Company – Rancho Cordova**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	16,932	Golden State Water Company. 2011. <i>Final Report, 2010 Urban Water Management Plan, Cordova.</i> July.
Water Sales to Others	–	–
Total Demand	16,932	–
Water Supplies for NAA		
CVP Water Supplies	–	Assumes no renewal of transfer of water from SMUD.
SWP Water Supplies	–	–
Other Imported Water Supplies	–	–
Local Surface Water Supplies	10,000	Up to 10,000 acre-feet pre-1914 water right from American River conveyed through the Folsom South Canal. However, only 5,000 acre-feet retained for Golden State Water Company and leases 5,000 acre-feet to City of Folsom. Up to 5,000 acre-feet replacement water from American River conveyed through the Folsom South Canal provided under a settlement with Gencorp/Aerojet Corporation, plus up to 10,200 acre-feet if necessary.
Groundwater	14,850	–
Recycled Wastewater	–	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	24,850	–
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	–	–
Total Potential Future Water Supplies	24,850	–

1 **Table 5D.20 Carmichael Water District**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	9,571	Carmichael Water District. 2011. <i>2010 Urban Water Management Plan</i> . June 20.
Water Sales to Others	–	–
Total Demand	9,571	–
Water Supplies for NAA		
CVP Water Supplies	–	–
SWP Water Supplies	–	–
Other Imported Water Supplies	–	–
Local Surface Water Supplies	32,627	Long-term average of 32,627 acre-feet of water rights on the American River under State Water Resources Control Board permits 1387 (10,859 acre-feet), 8731 (3,669 acre-feet), and 7356 (18,099 acre-feet).
Groundwater	8,156	6,646 acre-feet from local wells and 1,510 acre-feet from groundwater treatment processes.
Recycled Wastewater	–	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	40,783	–
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	–	–
Total Potential Future Water Supplies	40,783	–

1 **Table 5D.21 City of Sacramento**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	160,100	City of Sacramento. 2011. <i>2010 Urban Water Management Plan</i> . October.
Water Sales to Others	60,062	5,293 acre-feet sold to Sacramento International Airport. 16,593 acre-feet sold to Sacramento Suburban Water District. 11,553 acre-feet sold to Cal-Am Water Company. 22,994 acre-feet sold to Sacramento County Water Agency. 3,629 acre-feet sold to Fruitridge Vista Water Company.
Total Demand	220,162	–
Water Supplies for NAA		
CVP Water Supplies	–	–
SWP Water Supplies	–	–
Other Imported Water Supplies	–	–
Local Surface Water Supplies	238,684	Up to 81,800 acre-feet of water rights from Sacramento River under State Water Resources Control Board (SWRCB) Permit 992. Up to 245,000 acre-feet of water rights from American River and tributaries of the American River under SWRCB permits 11358, 11359, 11360, 11361.
Groundwater	22,300	–
Recycled Wastewater	–	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	260,984	–
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	–	–
Total Potential Future Water Supplies	260,984	–

1 **Table 5D.22 Solano County Water Agency**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	82,750	238,050 acre-feet Ag (Solano Irrigation District and Maine Prairie Water District) and M&I demands only include demands met by SWP entitlement and Reclamation Solano Project. Does not include demands met by local surface water and groundwater supplies. Solano County Water Agency. 2011. <i>2010 Solano County Water Agency Urban Water Management Plan, Final Draft.</i>
Water Sales to Others	-	-
Total Demand	82,750	238,050 Total Demand
Water Supplies for NAA		
CVP Water Supplies	-	-
SWP Water Supplies	30,564	47,756 acre-foot SWP Entitlement.
Other Imported Water Supplies	205,276	207,350 acre-feet with Reclamation Solano Project.
Local Surface Water Supplies	-	-
Groundwater	-	-
Recycled Wastewater	-	-
Recycled Stormwater	-	-
Desalination	-	-
Transfers/Exchanges	-	-
Conservation	-	-
Total Water Supplies for NAA	235,840	-
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	-	-
Total Potential Future Water Supplies	235,840	-

1 **Table 5D.23 Napa County Flood Control and Water Conservation District**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	21,572	5,712 acre-feet for American Canyon per City of American Canyon. 2011. <i>Final Urban Water Management Plan, 2010, Final</i> . September. 1,469 acre-feet for Calistoga per Napa County. 2007. <i>Draft Environmental Impact Report for Napa County General Plan</i> . February. 14,391 acre-feet for Napa per City of Napa. 2011. <i>Urban Water Management Plan, 2010 Update</i> . June 21.
Water Sales to Others	-	-
Total Demand	21,572	-
Water Supplies for NAA		
CVP Water Supplies	-	-
SWP Water Supplies	26,028	3,120 acre-feet for American Canyon per City of American Canyon. 2011. <i>Final Urban Water Management Plan, 2010, Final</i> . September. 1,008 acre-feet for Calistoga treated by City of Napa. Total 1,925 acre-foot SWP entitlement in 2010 per Napa County. 2007. <i>Draft Environmental Impact Report for Napa County General Plan</i> . February. Total amount available is limited 1,008 acre-feet due to conveyance limitations. 21,900 acre-feet for Napa per City of Napa. 2011. <i>Urban Water Management Plan, 2010 Update</i> . June 21. Assume 19,900 acre-feet due to conveyance limitations.
Other Imported Water Supplies	-	-
Local Surface Water Supplies	32,092	392 acre-feet for Calistoga from Kimball Reservoir per Napa County. 2007. <i>Draft Environmental Impact Report for Napa County General Plan</i> . February. 31,700 acre-feet for Napa from Lake Hennessey and Milliken Reservoir per City of Napa. 2011. <i>Urban Water Management Plan, 2010 Update</i> . June 21.
Groundwater	-	-

Appendix 5D: Municipal and Industrial Water Demands and Supplies

Items	Water Demand and Supplies (acre-feet)	Notes
Recycled Wastewater	5,605	1,065 acre-feet for American Canyon per City of American Canyon. 2011. <i>Final Urban Water Management Plan, 2010, Final</i> . September. 4,540 acre-feet for Napa per City of Napa. 2011. <i>Urban Water Management Plan, 2010 Update</i> . June 21.
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	1,527	1,027 acre-foot purchase by American Canyon from City of Vallejo, which diverts water from the Delta. Can be expanded to 1,527 acre-feet when SWP water reliability is reduced per City of American Canyon. 2011. <i>Final Urban Water Management Plan, 2010, Final</i> . September.
Conservation	–	–
Total Water Supplies for NAA	65,252	–
Possible Future Water Supplies	–	American Canyon can purchase water from Napa during emergencies per City of American Canyon. 2011. <i>Final Urban Water Management Plan, 2010, Final</i> . September.
Subtotal Possible Future Water Supplies	–	All future projects not included for M&I No Action Alternative assumptions since some of the future projects are not fully defined or analyzed.
Total Potential Future Water Supplies	65,252	–

1 **Table 5D.24 Stockton East Water District**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	64,960	64,960 acre-feet of demand met by Stockton East Water District within City of Stockton, California Water Service Company – Stockton District, and San Joaquin County per Stockton East Water District. 2011. <i>2010 Stockton East Water District Urban Water Management Plan Update</i> . June.
Water Sales to Others	–	–
Total Demand	64,960	–
Water Supplies for NAA		
CVP Water Supplies	24,000	24,000 acre-foot CVP water service contract on Stanislaus River from New Melones Reservoir.
SWP Water Supplies	–	–
Other Imported Water Supplies	–	–
Local Surface Water Supplies	20,000	20,000 acre-foot water rights on Calaveras River diverted from New Hogan Reservoir.
Groundwater	43,680	From groundwater bank.
Recycled Wastewater	–	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	30,000	Transfer from Oakdale Irrigation District and South San Joaquin Irrigation District.
Conservation	–	–
Total Water Supplies for NAA	117,680	–
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	–	–
Total Potential Future Water Supplies	117,680	–

1 **Table 5D.25 City of Tracy**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	31,000	City of Tracy. 2011. <i>2010 Urban Water Management Plan</i> . May.
Water Sales to Others	–	–
Total Demand	31,000	–
Water Supplies for NAA		
CVP Water Supplies	31,000	10,000 acre-foot CVP Water Service Contract (14-06-200-7858A), 5,000 acre-feet assigned CVP Water Service Contract from Banta-Carbona Irrigation District (14-06-200-4305A), and 5,000 acre-feet from assigned CVP Water Service Contract from West Side Irrigation District (7-07-20-W-0045). 11,000 acre-foot CVP Water Service Contract assigned from Byron-Bethany Irrigation District from acquisition from Plainview Water District (14-06-200-785).
SWP Water Supplies	–	–
Other Imported Water Supplies	–	–
Local Surface Water Supplies	16,000	13,000 acre-feet from pre-1914 water rights on the Stanislaus River from South County Water Supply Project. 3,000 acre-feet pre-1914 water rights from Byron-Bethany Irrigation District for annexations in City of Tracy.
Groundwater	2,500	Approximately up to 2,500 acre-feet/year. Up to 3,500 acre-feet banked in Semitropic Water Storage District Groundwater Bank, and 3,000 acre-feet in local groundwater.
Recycled Wastewater	–	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	49,500	–
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	–	–

Appendix 5D: Municipal and Industrial Water Demands and Supplies

Items	Water Demand and Supplies (acre-feet)	Notes
Total Potential Future Water Supplies	49,500	–

1 **Table 5D.26 City of Avenal**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	3,500	Includes demands for Avenal State Prison. Bureau of Reclamation. 2014. <i>Central Valley Project Municipal and Industrial Water Shortage Policy, Draft Environmental Impact Statement</i> . November.
Water Sales to Others	–	–
Total Demand	3,500	–
Water Supplies for NAA		
CVP Water Supplies	3,500	3,500 acre-foot CVP Water Service Contract (14-06-200-4619A).
SWP Water Supplies	–	–
Other Imported Water Supplies	–	–
Local Surface Water Supplies	–	–
Groundwater	–	–
Recycled Wastewater	–	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	3,500	–
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	–	–
Total Potential Future Water Supplies	3,500	–

1 **Table 5D.27 City of Coalinga**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	10,000	Includes demands for Coalinga State Hospital. Bureau of Reclamation. 2014. <i>Central Valley Project Municipal and Industrial Water Shortage Policy, Draft Environmental Impact Statement</i> . November.
Water Sales to Others	–	–
Total Demand	10,000	–
Water Supplies for NAA		
CVP Water Supplies	10,000	10,000 acre-foot CVP Water Service Contract (14-06-200-4173A).
SWP Water Supplies	–	–
Other Imported Water Supplies	–	–
Local Surface Water Supplies	–	–
Groundwater	–	CVP Water Service Contract signed in 1968 required Coalinga to abandon groundwater wells.
Recycled Wastewater	–	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	10,000	–
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	–	–
Total Potential Future Water Supplies	10,000	–

1 **Table 5D.28 City of Huron**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	3,000	Bureau of Reclamation. 2014. <i>Central Valley Project Municipal and Industrial Water Shortage Policy, Draft Environmental Impact Statement</i> . November.
Water Sales to Others	–	–
Total Demand	3,000	–
Water Supplies for NAA		
CVP Water Supplies	3,000	3,000 acre-foot CVP Water Service Contract (14-06-200-7081A).
SWP Water Supplies	–	–
Other Imported Water Supplies	–	–
Local Surface Water Supplies	–	–
Groundwater	–	–
Recycled Wastewater	–	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	3,000	–
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	–	–
Total Potential Future Water Supplies	3,000	–

1

Table 5D.29 City of Fresno

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	201,000	City of Fresno. 2012. <i>2010 Urban Water Management Plan</i> . November. Does not include 69,400 acre-feet for groundwater recharge.
Water Sales to Others	100	–
Total Demand	201,100	–
Water Supplies for NAA		
CVP Water Supplies	58,200	60,000 acre-foot CVP Water Service Contract from Friant-Kern Canal.
SWP Water Supplies	–	–
Other Imported Water Supplies	–	–
Local Surface Water Supplies	134,600	Basic allocation of 120,800 acre-feet from Fresno Irrigation District (FID) water rights on Kings River. City of Fresno receives 13,800 acre-feet from FID water rights on Kings River in exchange for recycled wastewater that recharges the groundwater in a portion of FID service area.
Groundwater	69,200	–
Recycled Wastewater	25,000	Recycled Wastewater. Could be combined with future transfers in exchange with surface water.
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	287,000	–
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	–	–
Total Potential Future Water Supplies	287,000	–

1 **Table 5D.30 City of Lindsay**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	2,689	City of Lindsay. 2013. <i>Water Feasibility Study, Draft Final Report</i> . October.
Water Sales to Others	–	–
Total Demand	2,689	–
Water Supplies for NAA		
CVP Water Supplies	1,450	Assumes 2,500 acre-foot CVP Water Service Contract (5-07-20-W0428) only available in summer months due to availability of Friant Kern Canal per City of Lindsay. 2013. <i>Water Feasibility Study, Draft Final Report</i> . October.
SWP Water Supplies	–	–
Other Imported Water Supplies	–	–
Local Surface Water Supplies	–	–
Groundwater	1,210	1,210 acre-feet from Well #14 per City of Lindsay. 2013. <i>Water Feasibility Study, Draft Final Report</i> . October. Well #15 can produce 1,937 acre-feet; however, not included in firm capacity.
Recycled Wastewater	–	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	2,660	–
Possible Future Water Supplies	3,630	3 new wells and treatment plant and distribution facilities improvements per City of Lindsay. 2013. <i>Water Feasibility Study, Draft Final Report</i> . October.
Subtotal Possible Future Water Supplies	3,630	–
Total Potential Future Water Supplies	6,290	–

1 **Table 5D.31 Kern County Water Agency Improvement District No. 4 and North of**
 2 **the River Municipal Water District**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	62,750	Kern County Water Agency Improvement District No. 4 and North of the River Municipal Water District. 2011. <i>2010 Urban Water Management Plan, Final.</i> June.
Water Sales to Others	–	–
Total Demand	62,750	–
Water Supplies for NAA		
CVP Water Supplies	–	–
SWP Water Supplies	82,946	Assumes 82,946 acre-feet of the 82,946-acre-foot SWP Water Service Entitlement.
Other Imported Water Supplies	–	–
Local Surface Water Supplies	–	–
Groundwater	68,126	Including Kern Water Bank, Pioneer Project Bank, and Allen Road Complex Well Field.
Recycled Wastewater	–	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	151,072	–
Possible Future Water Supplies	–	Including up to 96,000 acre-feet of transfers with Kern Delta Water District, Kern-Tulare Water District, Rosedale-Rio Bravo Water Storage District, and North Kern Water Storage District.
Subtotal Possible Future Water Supplies	–	All future projects not included for M&I No Action Alternative assumptions since some of the future projects are not fully defined or analyzed.
Total Potential Future Water Supplies	151,072	–

1 **5D.3 San Francisco Bay Area Region**

2 This section includes summaries of water demand and water supply projections
 3 for M&I users of CVP and SWP water supplies in the San Francisco Bay Area
 4 Region (see Tables 5D.32 through 5D.37). The M&I water users are generally
 5 organized geographically in this section from north to south.

6 **Table 5D.32 Contra Costa Water District**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	225,160	Contra Costa Water District. 2011. <i>Urban Water Management Plan</i> . June.
Water Sales to Others	–	–
Total Demand	225,160	–
Water Supplies for NAA		
CVP Water Supplies	195,000	195,000 acre-foot CVP Water Service Contract (175r-3401A-LTR1).
SWP Water Supplies	–	–
Other Imported Water Supplies	–	–
Local Surface Water Supplies	19,500	3,100 acre-foot water right from Mallard Slough. 6,400 acre-foot water right from San Joaquin River by City of Antioch. 10,000 acre-foot water right from San Joaquin River by industrial water users in Contra Costa Water District (CCWD) service area.
Groundwater	3,000	–
Recycled Wastewater	14,100	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	8,200	Purchase surplus water from East Contra Costa Irrigation District.
Conservation	–	–
Total Water Supplies for NAA	239,800	–
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	–	–
Total Potential Future Water Supplies	239,800	–

1 **Table 5D.33 East Bay Municipal Utility District**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	349,440 (Projected 2040 Water Demand)	East Bay Municipal Utility District. 2011. <i>Urban Water Management Plan 2010 Document</i> . June.
Water Sales to Others	–	–
Total Demand	349,440	–
Water Supplies for NAA		
CVP Water Supplies	Dry year supply	Up to 133,000 acre-feet in a dry year, with a maximum of 165,000 acre-feet over three dry years, CVP Water Service Contract (14-08-200-5183A-LTR1) from the American River.
SWP Water Supplies	–	–
Other Imported Water Supplies	Up to 240,800	East Bay Municipal Utility District has up to 364,037 acre-feet of water rights on the Mokelumne River, but available amount varies depending on hydrology per 2011. <i>Urban Water Management Plan 2010 Document</i> . June. “Other Imported Water Supplies” include East Bay Municipal Utility District’s entitlements on the Mokelumne River. Although East Bay Municipal Utility District has water rights up to 364,037 acre-feet, the actual amount available in any given year varies depending on hydrology, required releases to senior downstream water rights holders, and releases to meet instream flow requirements.
Local Surface Water Supplies	16,800	Water rights from local watersheds within the East Bay Municipal Utility District (EBMUD) watershed average 16,800 to 28,000 acre-feet per East Bay Municipal Utility District. 2011. <i>Urban Water Management Plan 2010 Document</i> .
Groundwater	Dry year supply	Up to 1,120 acre-feet in dry years from Bayside Groundwater Project Phase 1 groundwater recharge facility within EBMUD service area per East Bay Municipal Utility District. 2011. <i>Urban Water Management Plan 2010 Document</i> . June.

Appendix 5D: Municipal and Industrial Water Demands and Supplies

Items	Water Demand and Supplies (acre-feet)	Notes
Recycled Wastewater	22,400	22,400 acre-feet in East Bay Municipal Utility District. 2011. <i>Urban Water Management Plan 2010 Document</i> . June. East Bay Municipal Utility District's goal is to deliver 22,400 acre-feet of recycled water by the year 2040.
Recycled Stormwater	–	–
Desalination		
Transfers/Exchanges ^a	Dry year supply	5,040 to 49,952 acre-feet in dry years transfers from Northern California water users per East Bay Municipal Utility District. 2012. <i>Water Supply Management Program 2040 Plan</i> . April.
Conservation	69,440	East Bay Municipal Utility District's Water Conservation Master Plan is based on 69,440 acre-feet conservation in 2040 per East Bay Municipal Utility District. 2011. <i>Urban Water Management Plan 2010 Document</i> . June. East Bay Municipal Utility District's goal for conservation is 69,440 acre-feet by the year 2040.
Other Projects: Bayside Groundwater Project Phase 2 ^a	Dry year supply	2,240 to 10,080 acre-feet in dry years Bayside Groundwater Project Phase 2 per East Bay Municipal Utility District. 2011. <i>Urban Water Management Plan 2010 Document</i> . June.
Total Water Supplies for NAA	349,440 Non-Dry year supply	Does not include CVP water supply for dry years, up to 15 percent rationing in dry years, or other dry year supply projects. During normal years, East Bay Municipal Utility District anticipates having sufficient supplies to meet demands. Meeting customer demands during dry years will depend on the use of CVP supplies, rationing, and the implementation of additional water supply projects.
Possible Future Water Supplies		
Other Projects: Groundwater Banking outside of East Bay Municipal Utility District Service Area ^a	Dry year supply	Dry year supply of 4,704 acre-feet of groundwater banking in Sacramento Valley and/or 19,500 acre-feet in San Joaquin Valley; not anticipated until 2040 per East Bay Municipal Utility District. 2012. <i>Water Supply Management Program 2040 Plan</i> . April.

Appendix 5D: Municipal and Industrial Water Demands and Supplies

Items	Water Demand and Supplies (acre-feet)	Notes
Regional Desalination Facility ^a	Dry year supply–	Up to 22,400 acre-feet from regional desalination facility; however, not anticipated until 2040 per East Bay Municipal Utility District. 2012. <i>Water Supply Management Program 2040 Plan</i> . April.
Other Projects: Enlarge Lower Bear Reservoir ^a	Dry year supply–	Up to 4,500 acre-feet in dry years; however, not in plan for 2030 per East Bay Municipal Utility District. 2012. <i>Water Supply Management Program 2040 Plan</i> . April.
Other Projects: Expand Los Vaqueros Reservoir ^a	Dry year supply–	Exact amount available to be determined and additional study needed per East Bay Municipal Utility District. 2011. <i>Urban Water Management Plan 2010 Document</i> . June.
Subtotal Possible Future Water Supplies	–	All future projects not included for M&I No Action Alternative assumptions since some of the future projects are not fully defined or analyzed, or are scheduled to be completed after 2030.
Total Potential Future Water Supplies	349,440 Non-Dry year supply	Does not include CVP water supply for dry years, up to 15 percent rationing in dry years, or other dry year supply projects.

1 ^a East Bay Municipal Utility District has identified a range of water supply projects that it
2 will pursue simultaneously to meet future water needs. By considering a broad mix of
3 projects, with inherent scalability and the ability to adjust implementation schedules for a
4 particular component, East Bay Municipal Utility District will be able to minimize the risks
5 associated with future uncertainties such as project implementation challenges and
6 climate change. If East Bay Municipal Utility District is able to successfully develop one
7 component, this could result in deferral of other additional water supply components over
8 the planning period.

1 **Table 5D.34 Zone 7 Water Agency**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	66,300	Assume Low Water Demand to serve a portion of Livermore, Pleasanton, Dublin-San Ramon Services District, and Cal-Water Water Company, plus local retail treated and untreated water. Does not include 9,200 acre-feet for groundwater recharge. Zone 7 Water Agency. 2010. <i>2010 Urban Water Management Plan</i> . December 15.
Water Sales to Others	–	–
Total Demand	66,300	–
Water Supplies for NAA		
CVP Water Supplies	–	–
SWP Water Supplies	51,545	51,400 acre-feet from the 80,619 acre-foot SWP Water Entitlement. 145 acre-feet of SWP water from Yuba Accord. Portions are stored in Semitropic Water Storage District and Cawelo Water District groundwater banks, Lake Del Valle, and local groundwater.
Other Imported Water Supplies	–	–
Local Surface Water Supplies	7,100	Arroyo del Valle water rights.
Groundwater	9,200	Recharged by Zone 7 Water Agency; wells owned and operated by local agencies.
Recycled Wastewater	–	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	4,500	2,000 to 5,000 acre-feet from Byron-Bethany Irrigation District. Assume 4,500 acre-feet for long-term average.
Conservation	–	–
Total Water Supplies for NAA	72,345	–
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	72,345	–
Total Potential Future Water Supplies	–	–

1 **Table 5D.35 Alameda County Water District**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	71,800	Alameda County Water District. 2011 <i>Urban Water Management Plan, 2010-2015</i> . June 9.
Water Sales to Others	–	–
Total Demand	71,800	–
Water Supplies for NAA		
CVP Water Supplies	–	–
SWP Water Supplies	27,500	27,500 acre-feet of the 42,000-acre-foot SWP Water Entitlement, including SWP water stored in Semitropic Water Storage District groundwater bank. Could receive 13,500 to 33,500 acre-feet from groundwater bank.
Other Imported Water Supplies	15,400	15,400 acre-feet from the 15,400 acre-foot contract with San Francisco Public Utility Commission.
Local Surface Water Supplies	5,800	Up to 18,500 acre-feet from Del Valle Reservoir.
Groundwater	24,500	Up to 44,400 acre-feet for groundwater recharge and storage.
Recycled Wastewater	–	–
Recycled Stormwater	–	–
Desalination	5,100	Newark Desalination Facility.
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	78,300	–
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	–	–
Total Potential Future Water Supplies	78,300	–

1 **Table 5D.36 Santa Clara Valley Water District**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	409,370	Santa Clara Valley Water District. 2011. <i>Urban Water Management Plan 2010</i> . June.
Water Sales to Others	–	–
Total Demand	409,370	–
Water Supplies for NAA		
CVP Water Supplies	108,120	152,500 acre-foot CVP Water Service Contract (7-07-20-W0023). Assume 108,120 acre-feet on long-term average per Santa Clara Valley Water District. 2011. <i>Urban Water Management Plan 2010</i> . April.
SWP Water Supplies	64,000	100,000 acre-foot SWP Water Entitlement. Assume 64,000 acre-feet on long-term average per Santa Clara Valley Water District. 2011. <i>Urban Water Management Plan 2010</i> . April.
Other Imported Water Supplies	61,000	61,000 acre-feet per Santa Clara Valley Water District. 2012. <i>Water Supply and Infrastructure Master Plan</i> . October. Up to 63,850 acre-feet from San Francisco Public Utility Commission per Santa Clara Valley Water District. 2011. <i>Urban Water Management Plan 2010</i> . April.
Local Surface Water Supplies	95,000	102,000 acre-feet per Santa Clara Valley Water District. 2012. <i>Water Supply and Infrastructure Master Plan</i> . October. Includes about 11,000 -12,000 acre-feet non-district surface water supplies. 93,500 acre-feet based upon reported local supplies minus groundwater component per Santa Clara Valley Water District. 2011. <i>Urban Water Management Plan 2010</i> . April.
Groundwater	61,000	61,000 acre-feet per Santa Clara Valley Water District. 2012. <i>Water Supply and Infrastructure Master Plan</i> . October. 60,300 acre-feet of effective natural groundwater recharge in Santa Clara Plain, Coyote Valley, and Llagas Subbasin basins per Santa Clara Valley Water District. 2011. <i>Urban Water Management Plan 2010</i> . April.
Recycled Wastewater	29,000	Per Santa Clara Valley Water District. 2012. <i>Water Supply and Infrastructure Master Plan</i> . October.

Appendix 5D: Municipal and Industrial Water Demands and Supplies

Items	Water Demand and Supplies (acre-feet)	Notes
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	4,000	<p>Transfer from Patterson Irrigation District initiated in 2009 extended through 2024. This water is from Replacement Water, CVP Water Service Contract Water, and pre-1914 San Joaquin River water rights per Bureau of Reclamation. 2014. <i>Draft Findings of No Significant Impact, Patterson Irrigation District 10-Year Transfer and/or Warren Act Contract for up to 36,000 acre-feet of Available Surface Water Supply to Santa Clara Valley Water District.</i> May. Assume that this transfer is continued through 2030.</p> <p>Purchase of up to 20,000 acre-feet over a 20-year period from Pajaro Valley Water Management Agency during dry years; not included in long-term supply calculations. Assume 108,120 acre-feet on long-term average per Santa Clara Valley Water District. 2011. <i>Urban Water Management Plan 2010.</i> April.</p>
Conservation	–	–
Total Water Supplies for NAA	422,120	–
Possible Future Water Supplies		
Brackish Groundwater Treatment in Pajaro Watershed	–	Per Santa Clara Valley Water District. 2011. <i>Urban Water Management Plan 2010.</i> April. Not included in Santa Clara Valley Water District. 2014. <i>FY 2014-15 Protection and Augmentation of Water Supplies.</i> February.
Regional Desalination Facility	–	Per Santa Clara Valley Water District. 2011. <i>Urban Water Management Plan 2010.</i> April. Not recommended at this time 61,000 acre-feet per Santa Clara Valley Water District. 2012. <i>Water Supply and Infrastructure Master Plan.</i> October; or per Santa Clara Valley Water District. 2014. <i>FY 2014-15 Protection and Augmentation of Water Supplies.</i> February.
Subtotal Possible Future Water Supplies	–	All future projects not included for M&I No Action Alternative assumptions since some of the future projects are not fully defined or analyzed.
Total Potential Future Water Supplies	422,120	–

1 **Table 5D.37 San Benito County Water District, Zone 6**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	11,583	Per San Benito County Water District et al. (San Benito County Water District, Sunnyslope County Water District, and City of Hollister). 2011. <i>Draft Hollister Urban Area 2010 Urban Water Management Plan</i> . June 14. Does not include agricultural demands or groundwater use in San Juan Bautista, which does not directly use CVP water.
Water Sales to Others	100	–
Total Demand	11,683	–
Water Supplies for NAA		
CVP Water Supplies	8,250	43,800 acre-foot CVP Water Service Contract (8-07-20-W0130), including 8,250 acre-feet for Municipal & Industrial uses within Hollister and Sunnyslope County Water District. This use is limited by the Lessalt Water Treatment Plant capacity per San Benito County Water District et al. (San Benito County Water District, Sunnyslope County Water District, and City of Hollister). 2011. <i>Draft Hollister Urban Area 2010 Urban Water Management Plan</i> . June 14. Assumes expansion of water treatment plant capacity per Urban Water Management Plan and San Benito County Water District. 2014. <i>West Hills Water Treatment Plant Project, Draft Environmental Impact Report</i> . January. Remaining portion of the water supply, up to 35,550 acre-feet, is delivered to agricultural users and for groundwater recharge, which benefits Hollister, Sunnyslope, and San Juan Bautista communities.
SWP Water Supplies	–	–
Other Imported Water Supplies	–	–
Local Surface Water Supplies	–	–

Appendix 5D: Municipal and Industrial Water Demands and Supplies

Items	Water Demand and Supplies (acre-feet)	Notes
Groundwater	4,004	Per San Benito County Water District et al. (San Benito County Water District, Sunnyslope County Water District, and City of Hollister). 2011. <i>Draft Hollister Urban Area 2010 Urban Water Management Plan</i> . June 14. Storage has been purchased in Semitropic Water Storage District groundwater banking per San Benito County Water District. 2014. <i>West Hills Water Treatment Plant Project, Draft Environmental Impact Report</i> . January.
Recycled Wastewater	1,170	Per San Benito County Water District et al. (San Benito County Water District, Sunnyslope County Water District, and City of Hollister). 2011. <i>Draft Hollister Urban Area 2010 Urban Water Management Plan</i> . June 14.
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	13,424	–
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	–	–
Total Potential Future Water Supplies	13,424	–

1 **5D.4 Central Coast Region**

2 This section includes summaries of water demand and water supply projections
 3 for M&I users of SWP water supplies in the Central Coast Region (see
 4 Tables 5D.38 and 5D.39). The M&I water users are organized geographically in
 5 this section from north to south. The following water users contract with Central
 6 Coast Water Agency for SWP water supplies.

7 **Table 5D.38 San Luis Obispo County Flood Control and Water Conservation**
 8 **District**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	8,250	1,505 acre-feet for City of Morro Bay per City of Morro Bay. 2011. <i>Final Report, 2010 Urban Water Management Plan</i> June. 2,364 acre-feet for City of Pismo Beach per City of Pismo Beach. 2011. <i>2010 Urban Water Management Plan</i> . September. 1,135 acre-feet for California Men's Colony; 94 acre-feet for County Operations Center; 125 acre-feet for Cuesta College; 1,419 acre-feet for Oceano Community Services District; 393 acre-feet for San Miguelito Mutual Water Company; 170 acre-feet for Avila Beach Community Services District; 32 acre-feet for Avila Valley Mutual Water Company; 7 acre-feet for San Luis Coastal Unified School District through San Luis Obispo County Service Area No. 12; and 1,100 acre-feet for Shandon (San Luis Obispo County Service Area No. 16) per San Luis Obispo County Flood Control and Water Conservation District. 2012. <i>San Luis Obispo County Master Water Report</i> . May.
Water Sales to Others	-100	100 acre-feet from Oceano Community Services District to the City of Arroyo Grande.
Total Demand	8,150	-
Water Supplies for NAA		
CVP Water Supplies	-	-

Appendix 5D: Municipal and Industrial Water Demands and Supplies

Items	Water Demand and Supplies (acre-feet)	Notes
SWP Water Supplies	5,007	<p>1,313 acre-feet for City of Morro Bay of Central Coast Water Authority SWP Water Entitlement per City of Morro Bay. 2011. <i>Final Report, 2010 Urban Water Management Plan</i>. June.</p> <p>1,740 acre-feet for City of Pismo Beach per City of Pismo Beach. 2011. <i>2010 Urban Water Management Plan</i>. September.</p> <p>735 acre-feet for California Men's Colony; 150 acre-feet for County Operations Center; 140 acre-feet Cuesta College; 495 acre-feet for Oceano Community Services District; 275 acre-feet for San Miguelito Mutual Water Company; 66 acre-feet Avila Beach Community Services District; 20 acre-feet for Avila Valley Mutual Water Company; 7 acre-feet for San Luis Coastal Unified School District through San Luis Obispo County Service Area No. 12; and 66 acre-feet for Shandon (San Luis Obispo County Service Area No. 16) per San Luis Obispo County Flood Control and Water Conservation District. 2012. <i>San Luis Obispo County Master Water Report</i>. May.</p>
Other Imported Water Supplies	–	–
Local Surface Water Supplies	2,015	<p>896 acre-feet from Lopez Lake Reservoir for City of Pismo Beach per City of Pismo Beach. 2011. <i>2010 Urban Water Management Plan</i>. September.</p> <p>445 acre-feet from Whale Rock Reservoir and Chorro Reservoir for California Men's Colony; 28 acre-feet from Whale Rock Reservoir for County Operations Center; 303 acre-feet from Lopez Lake Reservoir for Oceano Community Services District; 263 acre-feet from San Miguelito Mutual Water Company; 68 acre-feet from Lopez Lake Reservoir for Avila Beach Community Services District; and 12 acre-feet from Lopez Lake Reservoir for Avila Valley Mutual Water Company per San Luis Obispo County Flood Control and Water Conservation District. 2012. <i>San Luis Obispo County Master Water Report</i>. May.</p>

Appendix 5D: Municipal and Industrial Water Demands and Supplies

Items	Water Demand and Supplies (acre-feet)	Notes
Groundwater	3,588	<p>1,723 acre-feet for City of Morro Bay per City of Morro Bay. 2011. <i>Final Report, 2010 Urban Water Management Plan</i>. June.</p> <p>700 acre-feet for City of Pismo Beach per City of Pismo Beach. 2011. <i>2010 Urban Water Management Plan</i>. September.</p> <p>900 acre-feet for Oceano Community Services District; 118 acre-feet for San Miguelito Mutual Water Company; and 147 acre-feet for Shandon (San Luis Obispo County Service Area No. 16) per San Luis Obispo County Flood Control and Water Conservation District. 2012. <i>San Luis Obispo County Master Water Report</i>. May.</p>
Recycled Wastewater	2,040	<p>1,840 acre-feet for City of Pismo Beach per City of Pismo Beach. 2011. <i>2010 Urban Water Management Plan</i>. September.</p> <p>200 acre-feet for California Men's Colony per San Luis Obispo Regional Water Management Group. 2014. <i>San Luis Obispo Integrated Regional Water Management Plan</i>. July.</p>
Recycled Stormwater	–	–
Desalination	645	645 acre-feet for City of Morro Bay per City of Morro Bay. 2011. <i>Final Report, 2010 Urban Water Management Plan</i> . June.
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	13,295	–
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	–	–
Total Potential Future Water Supplies	13,295	–

1 **Table 5D.39 Santa Barbara County Flood Control and Water Conservation District**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	72,515	<p>1,635 acre-feet for City of Guadalupe per City of Guadalupe. 2014. <i>Water Master Plan Update</i>. May 13.</p> <p>12,355 acre-feet for City of Santa Barbara per City of Santa Barbara. 2011. <i>Urban Water Management Plan, 2010 Update</i>. June.</p> <p>19,564 acre-feet for City of Santa Maria per City of Santa Maria. 2011. <i>2010 Urban Water Management Plan</i>. July.</p> <p>4,325 acre-feet for Carpinteria Valley Water District per Carpinteria Valley Water District. 2011. <i>Final 2010 Urban Water Management Plan Update</i>. June.</p> <p>14,113 acre-feet for Goleta Water District per Goleta Water District. 2011. <i>Final 2010 Urban Water Management Plan Update</i>. November.</p> <p>8,123 acre-feet for Golden State Water Company per Golden State Water Company. 2011. <i>Final Report, 2010 Urban Water Management Plan, Orcutt</i>. August.</p> <p>1,434 acre-feet for City of Buellton; 1,868 acre-feet for La Cumbre Mutual Water Company; 5,633 acre-feet for Montecito Water District; 1,929 acre-feet for Santa Ynez River Water Conservation District, Improvement District #1; and 1,371 acre-feet for Vandenberg Air Force Base per Santa Barbara County. 2014. <i>Integrated Regional Water Management Plan 2013</i>.</p> <p>33 acre-feet for Raytheon Systems Company and 132 acre-feet for Morehart Land Company (Naples Water Company) for SWP water demand only, per Central Coast Water Authority. 2011. <i>2010 Urban Water Management Plan</i>. June.</p>
Water Sales to Others	3,420	3,420 acre-feet for Golden State Water Company, Orcutt community, and Nipomo Community Services District from City of Santa Maria per City of Santa Maria. 2011. <i>2010 Urban Water Management Plan</i> . July.
Total Demand	75,935	–

Appendix 5D: Municipal and Industrial Water Demands and Supplies

Items	Water Demand and Supplies (acre-feet)	Notes
Water Supplies for NAA		
CVP Water Supplies	–	–
SWP Water Supplies	39,440	<p>367 acre-feet of the 550-acre-foot allocation of the Central Coast Water Authority SWP Water Entitlement for City of Guadalupe per City of Guadalupe. 2014. <i>Water Master Plan Update</i>. May 13.</p> <p>1,802 acre-feet of the 3,000-acre-foot allocation of the Central Coast Water Authority SWP Water Entitlement for City of Santa Barbara per City of Santa Barbara. 2011. <i>Urban Water Management Plan, 2010 Update</i>. June.</p> <p>22,936 acre-feet of the 16,200-acre-foot allocation of the Central Coast Water Authority SWP Water Entitlement for City of Santa Maria per City of Santa Maria. 2011. <i>2010 Urban Water Management Plan</i>. July.</p> <p>1,200 acre-feet of the 2,000-acre-foot allocation of the Central Coast Water Authority SWP Water Entitlement for Carpinteria Valley Water District per Carpinteria Valley Water District. 2011. <i>Final 2010 Urban Water Management Plan Update</i>. June.</p> <p>3,800 acre-feet of the 4,500-acre-foot allocation of the Central Coast Water Authority SWP Water Entitlement for Goleta Water District per Goleta Water District. 2011. <i>Final 2010 Urban Water Management Plan Update</i>. November.</p> <p>1,109 acre-feet of the 500-acre-foot allocation of the Central Coast Water Authority SWP Water Entitlement for Golden State Water Company per Golden State Water Company. 2011. <i>Final Report, 2010 Urban Water Management Plan, Orcutt</i>. August.</p>

Appendix 5D: Municipal and Industrial Water Demands and Supplies

Items	Water Demand and Supplies (acre-feet)	Notes
SWP Water Supplies (continued)	–	<p>386 acre-feet of the 578-acre-foot allocation of the Central Coast Water Authority SWP Water Entitlement for City of Buellton; 667 acre-feet of the 1,000-acre-foot allocation of the Central Coast Water Authority SWP Water Entitlement for La Cumbre Mutual Water Company; 2,002 acre-feet of the 3,000-acre-foot allocation of the Central Coast Water Authority SWP Water Entitlement for Montecito Water District; 1,335 acre-feet of the 2,000-acre-foot allocation of the Central Coast Water Authority SWP Water Entitlement for Santa Ynez River Water Conservation District, Improvement District #1; and 3,670 acre-feet of the 5,500-acre-foot allocation of the Central Coast Water Authority SWP Water Entitlement for Vandenberg Air Force Base per Santa Barbara County. 2014. <i>Integrated Regional Water Management Plan 2013</i>.</p> <p>33 acre-feet of the 50-acre-foot allocation of the Central Coast Water Authority SWP Water Entitlement for Raytheon Systems Company; and 133 acre-feet of the 200-acre-foot allocation of the Central Coast Water Authority SWP Water Entitlement for Morehart Land Company (Naples Water Company) per Central Coast Water Authority. 2011. <i>2010 Urban Water Management Plan</i>. June.</p>
Water Supplies from Reclamation Cachuma Project	23,534	<p>6,566 acre-feet for City of Santa Barbara per City of Santa Barbara. 2011. <i>Urban Water Management Plan, 2010 Update</i>. June.</p> <p>2,250 acre-feet for Carpinteria Valley Water District per Carpinteria Valley Water District. 2011. <i>Final 2010 Urban Water Management Plan Update</i>. June.</p> <p>9,322 acre-feet for Goleta Water District per Goleta Water District. 2011. <i>Final 2010 Urban Water Management Plan Update</i>. November.</p> <p>2,777 acre-feet for Montecito Water District; and 2,619 acre-feet for Santa Ynez River Water Conservation District, Improvement District #1 per Santa Barbara County. 2014. <i>Integrated Regional Water Management Plan 2013</i>.</p>

Appendix 5D: Municipal and Industrial Water Demands and Supplies

Items	Water Demand and Supplies (acre-feet)	Notes
Local Surface Water Supplies	21,742	<p>4,331 acre-feet of water rights on Santa Ynez River and Devils Canyon Creek for City of Santa Barbara per City of Santa Barbara. 2011. <i>Urban Water Management Plan, 2010 Update</i>. June.</p> <p>14,300 acre-feet from Twitchell Reservoir for City of Santa Maria per City of Santa Maria. 2011. <i>2010 Urban Water Management Plan</i>. July.</p> <p>611 acre-feet for City of Buellton; 1,500 acre-feet for Montecito Water District; and 1,000 acre-feet for Santa Ynez River Water Conservation District, Improvement District #1 per Santa Barbara County. 2014. <i>Integrated Regional Water Management Plan 2013</i>.</p>
Groundwater	29,664	<p>1,300 acre-feet with well modifications for City of Guadalupe per City of Guadalupe. 2014. <i>Water Master Plan Update</i>. May 13.</p> <p>1,125 acre-feet for City of Santa Barbara per City of Santa Barbara. 2011. <i>Urban Water Management Plan, 2010 Update</i>. June.</p> <p>12,795 acre-feet for City of Santa Maria per City of Santa Maria. 2011. <i>2010 Urban Water Management Plan</i>. July.</p> <p>2,000 acre-feet for Carpinteria Valley Water District per Carpinteria Valley Water District. 2011. <i>Final 2010 Urban Water Management Plan Update</i>. June.</p> <p>2,350 acre-feet for Goleta Water District per Goleta Water District. 2011. <i>Final 2010 Urban Water Management Plan Update</i>. November.</p> <p>10,094 acre-feet for Golden State Water Company per Golden State Water Company. 2011. <i>Final Report, 2010 Urban Water Management Plan, Orcutt</i>. August.</p> <p>Not quantified use for City of Buellton; La Cumbre Mutual Water Company; Montecito Water District; Santa Ynez River Water Conservation District, Improvement District #1; and Vandenberg Air Force Base per Santa Barbara County. 2014. <i>Integrated Regional Water Management Plan 2013</i>; and Central Coast Water Authority. 2011. <i>2010 Urban Water Management Plan</i>. June.</p>

Appendix 5D: Municipal and Industrial Water Demands and Supplies

Items	Water Demand and Supplies (acre-feet)	Notes
Recycled Wastewater	2,250	1,100 acre-feet for City of Santa Barbara per City of Santa Barbara. 2011. <i>Urban Water Management Plan, 2010 Update</i> . June. 1,150 acre-feet for Goleta Water District per Goleta Water District. 2011. <i>Final 2010 Urban Water Management Plan Update</i> . November.
Recycled Stormwater	–	–
Desalination	7,500	7,500 acre-feet Santa Barbara (based on websites accessed in January 2015 for City of Santa Barbara).
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	124,130	–
Possible Future Water Supplies	–	Modifications in groundwater management, desalination, and expansion of reclamation facilities for City of Santa Barbara per City of Santa Barbara. 2011. <i>Urban Water Management Plan, 2010 Update</i> . June. Desalination capacity of 3,125 acre-feet per Santa Barbara County. 2014. <i>Integrated Regional Water Management Plan 2013</i> . Additional wells, use of recycled water, increased use of local water rights per Carpinteria Valley Water District. 2011. <i>Final 2010 Urban Water Management Plan Update</i> . June. Water system improvements and additional groundwater facilities for cities of Buellton, Guadalupe, Santa Barbara, and Santa Maria, and Goleta Water District per Santa Barbara County. 2014. <i>Integrated Regional Water Management Plan 2013</i> .
Subtotal Possible Future Water Supplies	–	All future projects not included for M&I No Action Alternative assumptions since some of the future projects are not fully defined or analyzed.
Total Potential Future Water Supplies	124,130	–

1 **5D.5 Southern California Region**

2 This section includes summaries of water demand and water supply projections
 3 for M&I users of SWP water supplies in the Southern California Region (see
 4 Tables 5D.40 through 5D.50). The M&I water users are generally organized
 5 geographically in this section from north to south.

6 **Table 5D.40 Antelope Valley-East Kern Water Agency**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	96,558	Antelope Valley-East Kern Water Agency. 2011. <i>2010 Urban Water Management Plan</i> . June.
Water Sales to Others	–	–
Total Demand	96,558	–
Water Supplies for NAA		
CVP Water Supplies	–	–
SWP Water Supplies	87,688	87,688 acre-feet of the 141,400-acre-foot SWP Water Entitlement.
Other Imported Water Supplies	–	–
Local Surface Water Supplies	–	–
Groundwater	20,000	–
Recycled Wastewater	–	Recycled water is used by member agencies. The total is not quantified for the district.
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	107,688	–
Possible Future Water Supplies		
Subtotal Possible Future Water Supplies	–	–
Total Potential Future Water Supplies	107,688	–

1 **Table 5D.41 Castaic Lake Water Agency**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	105,313	Castaic Lake Water Agency, Newhall County Water District, and Valencia Water Company. 2011. <i>2010 Urban Water Management Plan, Final</i> . June.
Water Sales to Others	–	–
Total Demand	105,313	–
Water Supplies for NAA		
CVP Water Supplies	–	–
SWP Water Supplies	57,400	57,400 acre-feet of the 95,200-acre-foot SWP Water Entitlement.
Other Imported Water Supplies	17,287	17,287 from Flexible Storage Accounts with Ventura County; contracts with Buena Vista-Rosedale; and Newhall Land.
Local Surface Water Supplies	–	–
Groundwater	60,175	35,225 acre-feet of local groundwater and 24,950 acre-feet from groundwater banks in Kern County.
Recycled Wastewater	325	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	135,187	–
Possible Future Water Supplies		
–	14,375	Additional groundwater use, including groundwater banking.
–	7,775	Additional recycled wastewater.
Subtotal Possible Future Water Supplies	22,150	–
Total Potential Future Water Supplies	157,337	–

1 **Table 5D.42 Coachella Valley Water District**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	212,000	212,000 acre-feet for urban water use. Total water use of 670,800 acre-feet includes water demands for agricultural users and groundwater recharge per Coachella Valley Water District. 2011. <i>2010 Urban Water Management Plan, Final Report.</i> July.
Water Sales to Others	–	–
Total Demand	212,000	–
Water Supplies for NAA		
CVP Water Supplies	–	–
SWP Water Supplies	–	23,100 acre-foot SWP Water Entitlement plus 88,100 acre-feet from transfer of Metropolitan Water District of Southern California (MWDSC) SWP Entitlement and 27,150 acre-feet from transfers of SWP Entitlements from Kern County Water Users.
Other Imported Water Supplies	78,500	78,500 acre-foot Colorado River water supply for municipal and industrial uses. Approximately 428,000 acre-feet of Colorado River water supply for agricultural and groundwater recharge uses including 330,000 acre-foot Colorado R water right and additional 129,000 acre-feet from the Quantification Settlement Agreement (including SWP Water Entitlement that is exchanged with MWDSC).
Local Surface Water Supplies	–	–
Groundwater	133,500	–
Recycled Wastewater	26,840	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	238,840	–
Possible Future Water Supplies	–	Treated groundwater could provide 10,000 acre-feet additional supplies for agricultural supplies; scheduled for 2035. Additional water transfers.

Appendix 5D: Municipal and Industrial Water Demands and Supplies

Items	Water Demand and Supplies (acre-feet)	Notes
Subtotal Possible Future Water Supplies	–	All future projects not included for M&I No Action Alternative assumptions since some of the future projects are not fully defined or analyzed.
Total Potential Future Water Supplies	238,840	–

1 **Table 5D.43 Crestline-Lake Arrowhead Water Agency**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	2,250	Crestline-Lake Arrowhead Water Agency. 2011. <i>2010 Urban Water Management Plan</i> . August.
Water Sales to Others	–	–
Total Demand	2,250	–
Water Supplies for NAA		
CVP Water Supplies	–	–
SWP Water Supplies	3,480	5,800 SWP Water Entitlement.
Other Imported Water Supplies	–	–
Local Surface Water Supplies	481	Water right on Houston Creek conveyed through Lake Silverwood.
Groundwater	–	–
Recycled Wastewater	–	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	3,961	–
Possible Future Water Supplies	–	Potential future water transfers, including from SWP water users. Potential recycled water use for limited use due to high elevation within service area.
Subtotal Possible Future Water Supplies	–	All future projects not included for M&I No Action Alternative assumptions since some of the future projects are not fully defined or analyzed.
Total Potential Future Water Supplies	3,961	–

1 **Table 5D.44 Desert Water Agency**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	69,400	Desert Water Agency. 2011. <i>2010 Urban Water Management Plan</i> . March.
Water Sales to Others	–	–
Total Demand	69,400	–
Water Supplies for NAA		
CVP Water Supplies	–	–
SWP Water Supplies		38,100 acre-foot SWP Water Entitlement plus 11,900 acre-feet from transfer of MWDSC SWP Entitlement and 5,750 acre-feet from transfers of SWP Entitlements from Kern County Water Users.
Other Imported Water Supplies	27,200	27,200 acre-foot Colorado River water supply for groundwater recharge including SWP water that is exchanged with MWDSC.
Local Surface Water Supplies	5,900	Water rights on Snow Creek, Falls Creek, Chino Creek, and Whitewater River.
Groundwater	7,000	–
Recycled Wastewater	8,400	–
Recycled Stormwater	21,400	21,400 acre-feet in nonconsumptive returns to aquifer.
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	69,900	–
Possible Future Water Supplies	–	Potential future water transfers.
Subtotal Possible Future Water Supplies	–	All future projects not included for M&I No Action Alternative assumptions since some of the future projects are not fully defined or analyzed.
Total Potential Future Water Supplies	69,900	–

1 **Table 5D.45 Mojave Water Agency**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	192,969	Mojave Water Agency. 2011. <i>Final 2010 Urban Water Management Plan</i> . June.
Water Sales to Others	–	–
Total Demand	192,969	–
Water Supplies for NAA		
CVP Water Supplies	–	–
SWP Water Supplies	54,778	82,800 acre-foot SWP Water Entitlement and 14,000 acre-feet of SWP Water transferred from Dudley Ridge Water District.
Other Imported Water Supplies	–	–
Local Surface Water Supplies	54,045	–
Groundwater	92,789	Includes 10,425 for agricultural depletion and 82,364 from return flows returned to the groundwater and reused.
Recycled Wastewater	6,087	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	207,699	–
Possible Future Water Supplies	–	Potential water transfers, improved groundwater banking programs, and approaches to protect groundwater quality.
Subtotal Possible Future Water Supplies	–	All future projects not included for M&I No Action Alternative assumptions since some of the future projects are not fully defined or analyzed.
Total Potential Future Water Supplies	207,699	–

1 **Table 5D.46 Palmdale Water District**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	55,000	Palmdale Water District. 2011. <i>Urban Water Management Plan</i> . June.
Water Sales to Others	300	Sales to Littlerock Creek Irrigation District.
Total Demand	55,300	–
Water Supplies for NAA		
CVP Water Supplies	–	–
SWP Water Supplies	12,800	21,300 acre-foot SWP Water Entitlement.
Other Imported Water Supplies	–	–
Local Surface Water Supplies	4,000	Water rights on Little Rock and Big Rock creeks.
Groundwater	20,600	12,000 acre-feet of groundwater and 8,600 acre-feet from groundwater banking.
Recycled Wastewater	9,000	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	46,400	–
Possible Future Water Supplies	9,600	Future groundwater banking projects.
Subtotal Possible Future Water Supplies	9,600	–
Total Potential Future Water Supplies	55,000	–

1 **Table 5D.47 San Bernardino Valley Municipal Water District**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	305,447	San Bernardino Municipal Water District; East Valley Water District; cities of Loma Linda, Redlands, Colton, and San Bernardino; West Valley Water District; and Yucaipa Valley Water District. 2011. <i>2010 San Bernardino Valley Regional Urban Water Management Plan</i> . June.
Water Sales to Others	–	–
Total Demand	305,447	–
Water Supplies for NAA		
CVP Water Supplies	–	–
SWP Water Supplies	61,560	27,090 acre-foot direct delivery from 102,600-acre-foot SWP Water Entitlement, and 34,470 acre-feet from storage.
Other Imported Water Supplies	–	–
Local Surface Water Supplies	50,150	Water rights in the Santa Ana River watershed.
Groundwater	264,075	–
Recycled Wastewater	–	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	375,785	–
Possible Future Water Supplies	–	Water transfers.
Subtotal Possible Future Water Supplies	–	All future projects not included for M&I No Action Alternative assumptions since some of the future projects are not fully defined or analyzed.
Total Potential Future Water Supplies	375,785	–

1 **Table 5D.48 San Gorgonio Pass Water Agency**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	66,420	San Gorgonio Pass Water Agency. 2010. <i>2010 Urban Water Management Plan</i> . December.
Water Sales to Others	–	–
Total Demand	66,420	–
Water Supplies for NAA		
CVP Water Supplies	–	–
SWP Water Supplies	8,000	17,300 acre-foot SWP Water Entitlement primarily used for groundwater recharge.
Other Imported Water Supplies	–	–
Local Surface Water Supplies	3,000	Noble and Little San Gorgonio creeks used by Beaumont Cherry Valley Water District.
Groundwater	23,045	–
Recycled Wastewater	17,907	–
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	51,952	–
Possible Future Water Supplies	11,717	Expanded groundwater facilities.
–	–	Future water transfers.
Subtotal Possible Future Water Supplies	11,717	–
Total Potential Future Water Supplies	63,669	–

1 **Table 5D.49 Ventura County Watershed Protection District**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	10,365	The only portion of Ventura County Watershed Protection District that uses SWP Water not from Metropolitan Water District of Southern California is the Oxnard-Hueneme System of United Water Conservation District per United Water Conservation District. 2011 <i>Public Review Final, 2010 Urban Water Management Plan Update</i> . June.
Water Sales to Others	–	–
Total Demand	10,365	–
Water Supplies for NAA		
CVP Water Supplies	–	–
SWP Water Supplies	–	5,000 acre-feet for United Water Conservation District of the Ventura County Watershed Conservation District 20,000 acre-foot SWP Water Entitlement. The water is used for groundwater recharge. The 5,000 acre-feet for Casitas Municipal Water District and 10,000 acre-feet for the City of San Buenaventura (Ventura) cannot be conveyed to those areas and are transferred to others.
Other Imported Water Supplies	–	–
Local Surface Water Supplies	–	Surface water from Lake Piru is used for groundwater recharge.
Groundwater	10,365	–
Recycled Wastewater	–	49,000 acre-feet of recycled water used for groundwater recharge (32,000 acre-feet), wildlife habitat (8,000 acre-feet), and agriculture (9,000 acre-feet).
Recycled Stormwater	–	–
Desalination	–	–
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	10,365	–
Possible Future Water Supplies	–	Additional groundwater recharge and recycling.

Appendix 5D: Municipal and Industrial Water Demands and Supplies

Items	Water Demand and Supplies (acre-feet)	Notes
Subtotal Possible Future Water Supplies	–	All future projects not included for M&I No Action Alternative assumptions since some of the future projects are not fully defined or analyzed.
Total Potential Future Water Supplies	10,365	–

1 **Table 5D.50 Metropolitan Water District of Southern California**

Items	Water Demand and Supplies (acre-feet)	Notes
Water Demand		
Service Area Water Demand	4,454,000	Based on retail municipal and industrial and agricultural water demands. Metropolitan Water District of Southern California. 2010. <i>The Regional Urban Water Management Plan</i> . November.
Water Sales to Others	–	–
Total Demand	4,454,000	–
Water Supplies for NAA		
CVP Water Supplies	–	–
SWP Water Supplies	1,441,000	1,911,500 acre-foot SWP Water Entitlement (Table A); transfer of SWP with Desert Water Agency and Coachella Valley Water District; San Luis Reservoir carryover storage; Article 21 supplies; and Yuba River Accord purchases.
Other Imported Water Supplies	1,480,000	1,250,000 acre-feet from Colorado River. 230,000 acre-feet from Los Angeles Aqueduct.
Local Surface Water Supplies	102,000	
Groundwater	1,530,000	1,430,000 acre-feet for groundwater pumping and 100,000 acre-feet for groundwater recovery.
Recycled Wastewater	333,000	–
Recycled Stormwater	–	–
Desalination	166,000	11,000 acre-feet Long Beach; 16,000 acre-feet West Basin; 72,000 acre-feet Metropolitan Water District of Orange County from Huntington Beach and Doheny projects; 11,000 acre-feet Oceanside; 56,000 acre-feet San Diego County Water Agency from Camp Pendleton (based on websites accessed in January 2015 for the cities of Long Beach and Oceanside, Metropolitan Water District of Orange County, San Diego County Water Authority, and West Basin Municipal Water District).
Transfers/Exchanges	–	–
Conservation	–	–
Total Water Supplies for NAA	5,052,000	–

Appendix 5D: Municipal and Industrial Water Demands and Supplies

Items	Water Demand and Supplies (acre-feet)	Notes
Possible Future Water Supplies	–	605,000 acre-feet of Delta improvements and other programs not approved at this time.
Subtotal Possible Future Water Supplies	–	All future projects not included for M&I No Action Alternative assumptions since some of the future projects are not fully defined or analyzed.
Total Potential Future Water Supplies	5,052,000	–

1

1 **Appendix 5E**

2 **Sensitivity Analysis - Revised Second**
3 **Basis of Comparison with no Fremont**
4 **Weir Notch**

5 Comment Number 90 from State Water Contractors on the Draft LTO EIS
6 discussed that the Reasonable and Prudent Alternative (RPA) actions from the
7 2008 USFWS BO and 2009 NMFS BO should not have been included in the
8 Second Basis of Comparison, including a specific reference to restoration of tidal
9 habitat under Component 4 of the RPA in the USFWS BO and restoration of
10 floodplain habitat under Action I.6.1 of the RPA in the NMFS BO.

11 As described in Section 3.3.1.2 of Chapter 3, Description of Alternatives, in the
12 Draft EIS, tidal wetlands restoration activities under Component 4 of the USFWS
13 BO include actions adopted, initiated, or constructed since 2012 (e.g., Suisun
14 Marsh Habitat Management, Preservation, and Restoration Plan and restoration
15 activities in the Cache Slough area); and therefore, were considered to be included
16 in all of the alternatives and the Second Basis of Comparison.

17 As described in Section 3.3.1.2, substantial efforts have been completed to
18 develop floodplain restoration activities under Action I.6.1 of the NMFS BO;
19 however, specific details of the floodplain restoration activities have not been
20 completed at this time. Therefore, the EIS analysis used published assumptions
21 related to water operations associated with Action I.6.1, including use of an
22 operable gate to convey water from Sacramento River near Fremont Weir into
23 Yolo Bypass.

24 Although inclusion of an operable gate at the Fremont Weir is considered
25 reasonable and foreseeable and is included in the Second Basis of Comparison, a
26 sensitivity analysis without the operable gate was conducted to analyze possible
27 effects of the operable gate on overall system operations.

28 The inclusion of an operable gate at the Fremont Weir would primarily affect
29 flows in the Yolo Bypass and have minimal, if any effects, on flows in the
30 Sacramento River downstream of the Fremont Weir or in the Delta, as shown in
31 this sensitivity analysis. The model results of this sensitivity analysis are
32 presented in Section 5E.3 of this appendix.

33 **5E.1 Methodology**

34 CalSim II model simulation representing the Revised Second Basis of
35 Comparison¹ is rerun without an operable gate (notch) in the Fremont Weir. The
36 Revised Second Basis of Comparison 2 (SBC_R_2) is compared against the

¹ Please refer to Appendix 5C for detailed description of the Revised Second Basis of Comparison.

1 Revised Second Basis of Comparison (SBC_R) to identify the extent of the
2 effects of this change. As presented in the next section, the results show that the
3 effects of the removal of the Fremont Weir notch are primarily contained within
4 the Yolo Bypass and the Sacramento River downstream of the Fremont Weir.

5 **5E.2 Analysis Results**

6 Model results comparing Revised Second Basis of Comparison without an
7 operable gate (notch) in the Fremont Weir (SBC_R_2) to the Revised Second
8 Basis of Comparison (SBC_R) presented in Section 5E.3.1. Except for flow over
9 Fremont Weir from the Sacramento River, flow in the Yolo Bypass, and
10 Sacramento River flows at Freeport, all of the parameters are similar (less than 5
11 percent change) under both model runs.

12 In general, with the removal of the Fremont Weir notch, Fremont Weir spills to
13 Yolo Bypass are reduced. As a results of this, Yolo Bypass flows are reduced,
14 Sacramento River flows at Freeport are increased, and Sacramento River flows at
15 Rio Vista are similar. Because this is a rerouting of high flows, no additional
16 changes are observed in overall system.

17 **5E.3 Model Run Results**

18 Model results for the Revised Second Basis of Comparison compared with
19 Second Basis of Comparison Results are presented on the following pages.

20 5E.3.1 Trinity Storage

21 5E.3.2 Shasta Storage

22 5E.3.3 Oroville Storage

23 5E.3.4 Folsom Storage

24 5E.3.5 New Melones Storage

25 5E.3.6 Delta Outflow

26 5E.3.7 Exports through Jones and Banks Pumping Plants

27 5E.3.8 Trinity River below Lewiston Dam

28 5E.3.9 Clear Creek below Whiskeytown Dam

29 5E.3.10 Sacramento River downstream of Keswick Dam

30 5E.3.11 Feather River downstream of Thermalito Afterbay

31 5E.3.12 Fremont Weir Spills

32 5E.3.13 American River below Nimbus Dam

33 5E.3.14 Sacramento River at Freeport

- 1 5E.3.15 Yolo Bypass Flow
- 2 5E.3.16 Sacramento River at Rio Vista
- 3 5E.3.17 San Joaquin River at Vernalis Flow
- 4 5E.3.18 San Joaquin River at Vernalis Salinity
- 5 5E.3.19 Stanislaus River below Goodwin Flow
- 6 5E.3.20 Stanislaus River at Mouth Flow
- 7 5E.3.21 CALSIM II Summary Reporting Metrics, Long-Term Average and Dry
- 8 and Critical Year Averages, CVP Deliveries
- 9 5E.3.22 CALSIM II Summary Reporting Metrics, Long-Term Average and Dry
- 10 and Critical Year Averages, CVP
- 11 5E.3.23 CALSIM II Summary Reporting Metrics, Long-Term Average and Dry
- 12 and Critical Year Averages, SWP Deliveries
- 13 5E.3.24 CALSIM II Summary Reporting Metrics, Long-Term Average and Dry
- 14 and Critical Year Averages, SWP

This page left blank intentionally.

Table 5E.3.1. Trinity Lake, End of Month Storage

Revised Second Basis of Comparison		End of Month Storage (TAF)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,850	1,850	1,850	1,900	2,000	2,100	2,298	2,345	2,303	2,253	2,143	1,975
20%	1,805	1,840	1,850	1,900	2,000	2,100	2,257	2,276	2,199	2,059	1,922	1,822
30%	1,577	1,591	1,725	1,816	1,979	2,084	2,222	2,159	2,074	1,924	1,791	1,643
40%	1,386	1,446	1,567	1,701	1,865	2,023	2,131	2,029	1,919	1,767	1,588	1,422
50%	1,265	1,284	1,398	1,563	1,694	1,820	2,024	1,915	1,777	1,599	1,419	1,307
60%	1,173	1,200	1,226	1,341	1,538	1,709	1,778	1,749	1,671	1,497	1,329	1,218
70%	1,105	1,092	1,183	1,209	1,356	1,483	1,643	1,592	1,533	1,398	1,221	1,106
80%	942	958	979	1,053	1,143	1,267	1,442	1,429	1,332	1,166	1,054	972
90%	633	630	640	720	808	921	1,064	994	939	816	690	640
Long Term												
Full Simulation Period ^b	1,270	1,288	1,352	1,431	1,554	1,678	1,819	1,796	1,727	1,583	1,435	1,319
Water Year Types^c												
Wet (32%)	1,502	1,536	1,645	1,768	1,931	2,055	2,224	2,250	2,194	2,068	1,939	1,804
Above Normal (16%)	1,207	1,245	1,363	1,524	1,718	1,902	2,082	2,056	1,959	1,819	1,650	1,517
Below Normal (13%)	1,446	1,467	1,486	1,551	1,638	1,726	1,868	1,796	1,692	1,510	1,334	1,203
Dry (24%)	1,178	1,184	1,210	1,230	1,322	1,452	1,585	1,536	1,466	1,299	1,151	1,055
Critical (15%)	825	806	817	827	870	951	1,002	966	933	814	673	600

Revised Second Basis of Comparison 2		End of Month Storage (TAF)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,850	1,850	1,850	1,900	2,000	2,100	2,298	2,345	2,303	2,253	2,143	1,975
20%	1,805	1,840	1,850	1,900	2,000	2,100	2,254	2,276	2,193	2,056	1,920	1,822
30%	1,577	1,591	1,725	1,816	1,979	2,084	2,222	2,159	2,074	1,924	1,791	1,643
40%	1,386	1,446	1,567	1,701	1,865	2,022	2,131	2,029	1,919	1,766	1,588	1,422
50%	1,265	1,284	1,392	1,563	1,694	1,820	2,022	1,908	1,778	1,600	1,419	1,306
60%	1,175	1,199	1,226	1,341	1,538	1,709	1,778	1,749	1,671	1,496	1,330	1,219
70%	1,105	1,092	1,183	1,209	1,357	1,483	1,643	1,591	1,533	1,398	1,217	1,106
80%	941	958	979	1,052	1,143	1,266	1,442	1,429	1,332	1,166	1,054	972
90%	633	630	639	719	807	921	1,064	994	939	816	690	640
Long Term												
Full Simulation Period ^b	1,269	1,288	1,351	1,431	1,554	1,678	1,819	1,796	1,727	1,582	1,434	1,319
Water Year Types^c												
Wet (32%)	1,502	1,536	1,645	1,768	1,931	2,055	2,224	2,250	2,194	2,068	1,939	1,804
Above Normal (16%)	1,206	1,244	1,361	1,522	1,717	1,901	2,080	2,054	1,958	1,818	1,649	1,516
Below Normal (13%)	1,446	1,467	1,486	1,551	1,638	1,726	1,866	1,794	1,690	1,509	1,332	1,202
Dry (24%)	1,178	1,184	1,210	1,230	1,322	1,452	1,585	1,536	1,466	1,300	1,151	1,055
Critical (15%)	824	805	816	827	869	950	1,001	965	932	814	672	599

Revised Second Basis of Comparison 2 minus Revised Second Basis of Comparison		End of Month Storage (Percent Change)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Appendix 5E: Sensitivity Analysis - Revised Second Basis of Comparison with no Fremont Weir Notch

Table 5E.3.2. Shasta Lake, End of Month Storage

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Revised Second Basis of Comparison												
Probability of Exceedance ^a												
10%	3,250	3,252	3,359	3,632	3,911	4,220	4,499	4,552	4,434	3,902	3,563	3,400
20%	3,247	3,252	3,333	3,552	3,771	4,118	4,448	4,552	4,283	3,766	3,379	3,354
30%	3,117	3,191	3,302	3,513	3,674	4,020	4,384	4,532	4,155	3,550	3,183	3,095
40%	2,931	3,015	3,253	3,380	3,569	3,980	4,290	4,364	3,907	3,289	2,969	2,942
50%	2,687	2,782	3,116	3,320	3,492	3,917	4,175	4,238	3,704	3,139	2,777	2,749
60%	2,505	2,583	2,937	3,167	3,356	3,713	4,064	3,961	3,482	2,960	2,646	2,599
70%	2,364	2,479	2,619	2,922	3,252	3,513	3,906	3,729	3,335	2,793	2,536	2,456
80%	2,096	2,142	2,178	2,617	2,973	3,390	3,643	3,536	2,977	2,449	2,139	2,114
90%	1,404	1,374	1,488	2,077	2,347	2,775	2,720	2,950	2,583	1,968	1,590	1,536
Long Term												
Full Simulation Period ^b	2,534	2,582	2,755	3,023	3,287	3,641	3,916	3,907	3,539	3,009	2,677	2,613
Water Year Types ^c												
Wet (32%)	2,819	2,925	3,153	3,405	3,597	3,841	4,301	4,453	4,225	3,732	3,362	3,255
Above Normal (16%)	2,513	2,592	2,819	3,326	3,521	4,038	4,415	4,415	3,977	3,347	2,974	2,926
Below Normal (13%)	2,822	2,840	2,972	3,293	3,642	3,963	4,163	4,042	3,599	3,012	2,604	2,576
Dry (24%)	2,411	2,434	2,579	2,756	3,170	3,647	3,866	3,774	3,333	2,804	2,543	2,501
Critical (15%)	1,881	1,835	1,920	2,065	2,234	2,471	2,397	2,275	1,864	1,418	1,162	1,102

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Revised Second Basis of Comparison 2												
Probability of Exceedance ^a												
10%	3,250	3,252	3,359	3,632	3,911	4,220	4,499	4,552	4,434	3,902	3,563	3,400
20%	3,247	3,252	3,333	3,552	3,771	4,118	4,448	4,552	4,283	3,766	3,378	3,354
30%	3,117	3,191	3,302	3,513	3,674	4,020	4,384	4,532	4,155	3,550	3,183	3,095
40%	2,930	3,015	3,253	3,380	3,569	3,980	4,290	4,364	3,907	3,289	2,967	2,941
50%	2,687	2,782	3,116	3,320	3,492	3,917	4,175	4,241	3,707	3,139	2,776	2,749
60%	2,505	2,582	2,936	3,167	3,356	3,712	4,064	3,961	3,481	2,960	2,646	2,599
70%	2,359	2,480	2,619	2,922	3,252	3,513	3,906	3,729	3,335	2,793	2,536	2,456
80%	2,096	2,142	2,178	2,617	2,973	3,390	3,643	3,536	2,979	2,451	2,139	2,114
90%	1,403	1,374	1,487	2,073	2,347	2,775	2,720	2,950	2,582	1,967	1,590	1,535
Long Term												
Full Simulation Period ^b	2,534	2,581	2,755	3,023	3,287	3,641	3,916	3,907	3,539	3,009	2,677	2,613
Water Year Types ^c												
Wet (32%)	2,819	2,925	3,153	3,405	3,597	3,841	4,301	4,453	4,225	3,732	3,362	3,255
Above Normal (16%)	2,512	2,591	2,818	3,325	3,521	4,038	4,415	4,415	3,977	3,346	2,974	2,926
Below Normal (13%)	2,822	2,840	2,972	3,292	3,642	3,963	4,165	4,043	3,601	3,013	2,606	2,577
Dry (24%)	2,411	2,434	2,579	2,756	3,169	3,647	3,865	3,774	3,333	2,804	2,542	2,501
Critical (15%)	1,880	1,833	1,919	2,063	2,232	2,470	2,395	2,273	1,862	1,416	1,161	1,101

Statistic	End of Month Storage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Revised Second Basis of Comparison 2 minus Revised Second Basis of Comparison												
Probability of Exceedance ^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types ^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Appendix 5E: Sensitivity Analysis - Revised Second Basis of Comparison with no Fremont Weir Notch

Table 5E.3.3. Lake Oroville, End of Month Storage

Revised Second Basis of Comparison												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,613	2,547	2,788	2,807	2,948	3,052	3,352	3,538	3,538	3,037	2,860	2,729
20%	2,277	2,324	2,490	2,788	2,831	2,990	3,298	3,538	3,532	2,959	2,592	2,458
30%	1,932	1,996	2,165	2,565	2,788	2,937	3,268	3,474	3,274	2,756	2,385	2,112
40%	1,687	1,759	2,023	2,372	2,780	2,844	3,209	3,275	2,945	2,340	1,988	1,789
50%	1,406	1,421	1,705	2,204	2,574	2,788	3,084	3,022	2,634	2,121	1,785	1,601
60%	1,143	1,078	1,383	1,682	2,133	2,621	2,885	2,777	2,418	1,913	1,588	1,376
70%	1,034	1,001	1,047	1,307	1,868	2,209	2,499	2,470	2,053	1,723	1,392	1,228
80%	998	959	985	1,109	1,538	1,789	1,938	2,034	1,805	1,443	1,255	1,097
90%	913	876	851	1,003	1,198	1,471	1,575	1,584	1,335	1,113	994	891
Long Term												
Full Simulation Period ^b	1,584	1,580	1,736	1,972	2,253	2,470	2,732	2,792	2,561	2,152	1,891	1,721
Water Year Types^c												
Wet (32%)	1,940	1,983	2,353	2,633	2,869	2,942	3,300	3,478	3,392	2,969	2,730	2,571
Above Normal (16%)	1,465	1,521	1,697	2,166	2,644	2,939	3,274	3,359	3,079	2,491	2,085	1,823
Below Normal (13%)	1,831	1,796	1,839	2,046	2,376	2,642	2,892	2,844	2,460	1,933	1,635	1,413
Dry (24%)	1,354	1,306	1,327	1,456	1,745	2,101	2,345	2,339	2,012	1,668	1,409	1,248
Critical (15%)	1,101	1,028	1,032	1,119	1,227	1,398	1,415	1,398	1,210	1,018	904	840

Revised Second Basis of Comparison 2												
Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,613	2,547	2,788	2,807	2,948	3,052	3,352	3,538	3,538	3,037	2,860	2,729
20%	2,277	2,323	2,490	2,788	2,831	2,990	3,298	3,538	3,531	2,959	2,592	2,458
30%	1,931	1,996	2,165	2,565	2,788	2,937	3,268	3,474	3,273	2,756	2,384	2,112
40%	1,687	1,759	2,023	2,372	2,780	2,844	3,209	3,275	2,945	2,340	1,988	1,790
50%	1,407	1,421	1,705	2,204	2,574	2,788	3,084	3,021	2,636	2,120	1,785	1,600
60%	1,143	1,077	1,383	1,709	2,133	2,621	2,886	2,777	2,417	1,913	1,588	1,377
70%	1,035	1,001	1,035	1,307	1,880	2,230	2,498	2,470	2,053	1,723	1,392	1,229
80%	998	960	985	1,107	1,538	1,790	1,938	2,034	1,805	1,462	1,266	1,097
90%	914	876	851	1,003	1,198	1,471	1,577	1,582	1,333	1,113	994	892
Long Term												
Full Simulation Period ^b	1,584	1,579	1,736	1,972	2,253	2,471	2,733	2,792	2,562	2,153	1,892	1,721
Water Year Types^c												
Wet (32%)	1,940	1,983	2,353	2,633	2,869	2,942	3,300	3,478	3,392	2,969	2,730	2,571
Above Normal (16%)	1,466	1,519	1,695	2,164	2,642	2,939	3,274	3,359	3,079	2,490	2,085	1,822
Below Normal (13%)	1,831	1,796	1,839	2,046	2,376	2,643	2,892	2,844	2,461	1,937	1,640	1,417
Dry (24%)	1,355	1,307	1,330	1,459	1,748	2,104	2,348	2,342	2,015	1,671	1,412	1,248
Critical (15%)	1,097	1,025	1,030	1,117	1,226	1,396	1,414	1,396	1,208	1,016	903	838

Revised Second Basis of Comparison 2 minus Revised Second Basis of Comparison												
Statistic	End of Month Storage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	2%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	-1%	0%	1%	1%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	1%	0%
90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5E.3.4. Folsom Lake, End of Month Storage

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Revised Second Basis of Comparison												
Probability of Exceedance ^a												
10%	692	567	567	567	567	661	792	967	967	903	792	750
20%	580	558	567	567	567	657	792	967	967	816	685	631
30%	548	520	566	563	559	653	792	967	965	725	634	608
40%	472	498	523	554	555	646	792	967	908	639	567	526
50%	396	429	493	523	541	633	792	955	797	546	461	424
60%	349	394	456	470	498	621	790	858	731	497	438	403
70%	329	353	405	428	457	600	733	760	631	432	386	360
80%	285	337	358	388	432	563	635	655	545	376	329	315
90%	253	260	267	304	392	453	484	471	428	311	244	233
Long Term												
Full Simulation Period ^b	430	422	456	474	494	592	715	823	755	577	502	469
Water Year Types ^c												
Wet (32%)	483	469	522	524	515	632	785	951	936	793	687	646
Above Normal (16%)	388	410	465	537	538	640	787	946	851	584	517	479
Below Normal (13%)	505	488	501	514	541	626	762	848	739	476	404	385
Dry (24%)	402	396	421	437	486	585	699	768	662	486	432	407
Critical (15%)	336	315	322	323	367	433	467	479	429	349	290	257

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Revised Second Basis of Comparison 2												
Probability of Exceedance ^a												
10%	692	567	567	567	567	661	792	967	967	903	792	750
20%	580	558	567	567	567	657	792	967	967	816	685	631
30%	548	520	566	563	559	653	792	967	965	725	634	608
40%	472	498	523	554	555	646	792	967	908	639	567	526
50%	396	430	493	523	541	633	792	955	797	546	462	424
60%	349	394	456	470	498	621	790	858	731	497	438	403
70%	329	353	405	428	457	600	733	760	631	432	386	360
80%	284	336	358	388	432	563	636	655	545	376	329	314
90%	253	260	267	304	392	453	485	471	427	310	244	233
Long Term												
Full Simulation Period ^b	430	422	456	474	494	592	715	823	755	577	502	469
Water Year Types ^c												
Wet (32%)	483	469	522	524	515	632	785	951	936	793	687	646
Above Normal (16%)	389	411	465	537	538	640	787	946	851	584	517	479
Below Normal (13%)	505	488	501	514	541	626	762	848	739	476	405	386
Dry (24%)	402	396	421	437	486	585	699	768	662	486	432	407
Critical (15%)	335	314	321	323	367	432	467	479	429	348	290	256

Statistic	End of Month Storage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Revised Second Basis of Comparison 2 minus Revised Second Basis of Comparison												
Probability of Exceedance ^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types ^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5E.3.5. New Melones Reservoir, End of Month Storage

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Revised Second Basis of Comparison												
Probability of Exceedance^a												
10%	1,879	1,859	1,935	1,954	1,970	2,030	2,043	2,167	2,141	2,080	1,971	1,911
20%	1,775	1,776	1,788	1,823	1,966	1,979	1,955	1,999	2,045	1,947	1,838	1,781
30%	1,666	1,660	1,703	1,764	1,807	1,896	1,885	1,955	1,912	1,817	1,712	1,661
40%	1,508	1,514	1,596	1,693	1,771	1,801	1,788	1,756	1,711	1,634	1,541	1,496
50%	1,364	1,362	1,396	1,478	1,611	1,671	1,625	1,668	1,621	1,512	1,417	1,360
60%	1,257	1,260	1,320	1,353	1,393	1,474	1,492	1,532	1,474	1,381	1,300	1,249
70%	1,074	1,086	1,146	1,224	1,231	1,230	1,250	1,343	1,299	1,204	1,111	1,055
80%	843	824	852	894	999	1,049	1,078	1,094	1,039	975	902	861
90%	705	711	716	724	802	806	749	817	842	775	722	718
Long Term												
Full Simulation Period ^b	1,316	1,321	1,355	1,411	1,470	1,522	1,522	1,564	1,559	1,470	1,373	1,319
Water Year Types^c												
Wet (32%)	1,534	1,539	1,596	1,700	1,784	1,864	1,901	2,027	2,087	2,001	1,880	1,802
Above Normal (16%)	1,225	1,252	1,315	1,405	1,501	1,594	1,613	1,686	1,664	1,566	1,468	1,420
Below Normal (13%)	1,479	1,484	1,500	1,522	1,576	1,605	1,579	1,581	1,555	1,457	1,359	1,313
Dry (24%)	1,285	1,280	1,287	1,303	1,335	1,369	1,351	1,338	1,291	1,197	1,112	1,067
Critical (15%)	845	843	858	869	887	885	837	789	751	682	617	587

Statistic	End of Month Storage (TAF)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Revised Second Basis of Comparison 2												
Probability of Exceedance^a												
10%	1,879	1,859	1,935	1,954	1,970	2,030	2,043	2,167	2,141	2,080	1,971	1,911
20%	1,775	1,776	1,788	1,823	1,966	1,979	1,955	1,999	2,045	1,947	1,838	1,781
30%	1,666	1,660	1,703	1,764	1,807	1,896	1,885	1,955	1,912	1,817	1,712	1,661
40%	1,508	1,514	1,596	1,693	1,771	1,801	1,788	1,756	1,711	1,634	1,541	1,496
50%	1,364	1,362	1,396	1,478	1,611	1,671	1,625	1,668	1,621	1,512	1,417	1,360
60%	1,257	1,260	1,320	1,353	1,393	1,474	1,492	1,532	1,474	1,381	1,300	1,249
70%	1,074	1,086	1,146	1,224	1,231	1,230	1,250	1,343	1,299	1,204	1,111	1,055
80%	843	824	852	894	999	1,049	1,078	1,094	1,039	975	902	861
90%	705	711	716	724	802	806	749	817	842	775	722	718
Long Term												
Full Simulation Period ^b	1,316	1,321	1,355	1,411	1,470	1,522	1,522	1,564	1,559	1,470	1,373	1,319
Water Year Types^c												
Wet (32%)	1,534	1,539	1,596	1,700	1,784	1,864	1,901	2,027	2,087	2,001	1,880	1,802
Above Normal (16%)	1,225	1,252	1,315	1,405	1,501	1,594	1,613	1,686	1,664	1,566	1,468	1,420
Below Normal (13%)	1,479	1,484	1,500	1,522	1,576	1,605	1,579	1,581	1,555	1,457	1,359	1,313
Dry (24%)	1,285	1,280	1,287	1,303	1,335	1,369	1,351	1,338	1,291	1,197	1,112	1,067
Critical (15%)	845	843	858	869	887	885	837	789	751	682	617	587

Statistic	End of Month Storage (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Revised Second Basis of Comparison 2 minus Revised Second Basis of Comparison												
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5E.3.6. Sacramento/San Joaquin River Delta Outflow, Monthly Outflow Volume

Revised Second Basis of Comparison													
Statistic	Monthly Outflow Volume (TAF)												
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	TOT
Probability of Exceedance^a													
10%	373	895	4,048	6,551	8,106	5,795	3,956	2,541	1,141	670	271	259	30,929
20%	286	384	2,029	4,469	4,884	4,375	2,589	1,579	658	581	247	240	24,158
30%	269	329	947	2,826	3,377	2,686	1,466	952	591	508	246	234	18,772
40%	257	291	635	1,561	2,882	2,060	1,215	790	559	492	246	229	14,349
50%	246	269	464	1,078	1,898	1,614	859	715	512	461	246	221	9,721
60%	246	268	371	829	1,168	1,103	726	675	495	400	246	184	8,015
70%	246	268	312	665	918	899	599	560	439	307	246	179	6,505
80%	246	268	277	501	720	751	565	533	422	307	236	179	5,871
90%	232	208	277	405	596	601	528	437	369	246	215	179	5,025
Long Term													
Full Simulation Period ^b	289	508	1,407	2,590	3,140	2,678	1,609	1,159	704	457	252	238	15,030
Water Year Types^c													
Wet (32%)	345	794	3,009	5,453	5,819	5,073	3,004	2,182	1,199	607	271	321	28,075
Above Normal (16%)	252	566	1,394	2,837	3,821	3,313	1,620	1,021	569	599	250	223	16,464
Below Normal (13%)	294	433	540	878	2,078	1,075	812	715	532	429	254	208	8,248
Dry (24%)	267	297	433	821	1,268	1,232	879	627	455	310	244	191	7,025
Critical (15%)	241	244	367	640	692	680	525	385	346	247	229	179	4,774

Revised Second Basis of Comparison 2													
Statistic	Monthly Outflow Volume (TAF)												
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	TOT
Probability of Exceedance^a													
10%	373	895	4,048	6,551	8,106	5,795	3,956	2,541	1,141	670	271	259	30,930
20%	286	384	2,017	4,469	4,884	4,375	2,589	1,579	658	581	247	240	24,159
30%	269	329	947	2,826	3,377	2,686	1,466	952	591	508	246	234	18,773
40%	257	291	635	1,561	2,882	2,060	1,215	790	559	492	246	229	14,348
50%	246	269	464	1,078	1,898	1,614	859	715	513	461	246	221	9,720
60%	246	268	371	839	1,168	1,103	726	675	495	400	246	184	8,015
70%	246	268	312	665	918	899	599	560	439	307	246	179	6,504
80%	246	268	277	501	720	751	565	534	422	307	236	179	5,872
90%	233	208	277	405	596	601	528	437	369	246	215	179	5,025
Long Term													
Full Simulation Period ^b	289	508	1,406	2,591	3,140	2,677	1,609	1,159	704	457	253	238	15,031
Water Year Types^c													
Wet (32%)	345	794	3,008	5,453	5,819	5,073	3,004	2,182	1,199	607	271	321	28,075
Above Normal (16%)	252	566	1,393	2,837	3,822	3,311	1,620	1,021	570	599	250	223	16,464
Below Normal (13%)	294	433	540	878	2,077	1,075	812	716	532	428	254	208	8,247
Dry (24%)	267	297	434	821	1,268	1,232	879	628	455	310	245	191	7,026
Critical (15%)	241	244	365	643	692	680	525	385	346	247	229	179	4,774

Revised Second Basis of Comparison 2 minus Revised Second Basis of Comparison													
Statistic	Monthly Outflow Volume (Percent Change)												
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	TOT
Probability of Exceedance^a													
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
90%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term													
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c													
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5E.3.7. Exports Through Jones and Banks Pumping Plants, Monthly Export Volume

Revised Second Basis of Comparison													
Statistic	Monthly Export Volume (TAF)												
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	TOT
Probability of Exceedance ^a													
10%	694	671	738	803	722	707	530	515	526	694	694	671	7,327
20%	681	671	723	769	684	619	508	417	450	694	694	671	6,944
30%	626	659	719	746	666	563	481	369	429	691	694	671	6,761
40%	551	622	717	738	602	542	433	351	408	609	621	668	6,571
50%	488	590	683	724	552	512	391	314	392	555	529	628	6,266
60%	426	502	609	645	512	489	336	277	353	474	468	549	5,943
70%	327	460	554	562	461	459	264	228	316	390	364	408	5,000
80%	249	349	492	499	393	373	189	169	176	306	281	338	4,572
90%	196	286	382	371	309	301	109	81	128	146	183	228	3,458
Long Term													
Full Simulation Period ^b	467	524	613	638	528	491	355	302	349	494	487	526	5,775
Water Year Types ^c													
Wet (32%)	544	620	717	724	587	554	485	428	451	632	653	660	7,055
Above Normal (16%)	419	520	641	719	590	568	455	359	411	574	647	648	6,553
Below Normal (13%)	544	595	629	670	471	498	342	296	413	631	525	543	6,156
Dry (24%)	434	472	550	567	516	491	262	221	273	401	323	431	4,941
Critical (15%)	336	340	444	451	405	264	135	110	132	138	195	249	3,199

Revised Second Basis of Comparison 2													
Statistic	Monthly Export Volume (TAF)												
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	TOT
Probability of Exceedance ^a													
10%	694	671	738	803	722	707	530	515	526	694	694	671	7,325
20%	681	671	723	769	684	618	508	417	450	694	694	671	6,943
30%	626	659	719	746	666	563	481	369	428	691	694	671	6,760
40%	551	622	717	738	607	542	433	351	408	609	620	668	6,571
50%	488	590	683	724	552	512	391	314	392	556	529	629	6,277
60%	426	502	609	640	512	489	336	278	353	473	471	550	5,942
70%	346	460	554	562	461	458	264	228	316	390	364	408	4,999
80%	265	349	491	499	393	373	189	168	176	306	281	337	4,572
90%	196	286	382	371	309	301	107	81	128	146	183	228	3,458
Long Term													
Full Simulation Period ^b	468	524	613	637	528	491	355	302	349	494	488	526	5,775
Water Year Types ^c													
Wet (32%)	544	620	717	724	587	554	485	428	451	632	653	660	7,055
Above Normal (16%)	424	520	642	719	591	567	455	359	411	574	647	648	6,558
Below Normal (13%)	544	594	629	670	471	498	341	296	413	628	524	543	6,151
Dry (24%)	435	472	550	567	516	491	262	220	273	401	323	431	4,941
Critical (15%)	339	340	444	448	405	264	135	110	132	138	195	249	3,199

Revised Second Basis of Comparison 2 minus Revised Second Basis of Comparison													
Statistic	Monthly Export Volume (Percent Change)												
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	TOT
Probability of Exceedance ^a													
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	-1%	0%	0%	0%	0%	0%	0%	1%	0%	0%
70%	6%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	6%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
90%	0%	0%	0%	0%	0%	0%	-1%	0%	0%	0%	0%	0%	0%
Long Term													
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types ^c													
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	1%	0%	0%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5E.3.8. Trinity River below Lewiston Reservoir, Monthly Flow

Revised Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	373	300	300	1,448	2,151	387	600	4,709	4,626	1,102	450	450
20%	373	300	300	300	300	300	540	4,709	2,526	1,102	450	450
30%	373	300	300	300	300	300	540	4,570	2,526	1,102	450	450
40%	373	300	300	300	300	300	521	4,570	2,526	1,102	450	450
50%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
60%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
70%	373	300	300	300	300	300	460	2,924	783	450	450	450
80%	373	300	300	300	300	300	460	2,924	783	450	450	450
90%	373	300	300	300	300	300	427	1,498	783	450	450	450
Long Term												
Full Simulation Period ^b	366	361	659	738	747	668	555	3,753	2,210	890	450	445
Water Year Types^c												
Wet (32%)	373	504	1,432	1,645	1,319	1,380	632	4,556	3,413	1,136	450	450
Above Normal (16%)	373	300	300	374	801	462	457	4,597	2,948	1,102	450	450
Below Normal (13%)	373	300	300	300	630	303	517	3,585	1,755	924	450	450
Dry (24%)	354	300	300	300	300	300	528	3,250	1,271	678	450	450
Critical (15%)	357	275	300	300	300	300	575	2,092	783	450	450	413

Revised Second Basis of Comparison 2

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	373	300	300	1,448	2,149	380	600	4,709	4,626	1,102	450	450
20%	373	300	300	300	300	300	540	4,709	2,526	1,102	450	450
30%	373	300	300	300	300	300	540	4,570	2,526	1,102	450	450
40%	373	300	300	300	300	300	521	4,570	2,526	1,102	450	450
50%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
60%	373	300	300	300	300	300	493	4,189	2,120	1,102	450	450
70%	373	300	300	300	300	300	460	2,924	783	450	450	450
80%	373	300	300	300	300	300	460	2,924	783	450	450	450
90%	373	300	300	300	300	300	427	1,498	783	450	450	450
Long Term												
Full Simulation Period ^b	364	361	659	738	746	668	556	3,753	2,210	890	450	445
Water Year Types^c												
Wet (32%)	373	504	1,432	1,645	1,317	1,380	633	4,556	3,413	1,136	450	450
Above Normal (16%)	373	300	300	374	801	462	457	4,597	2,948	1,102	450	450
Below Normal (13%)	373	300	300	300	630	303	517	3,585	1,755	924	450	450
Dry (24%)	354	300	300	300	300	300	528	3,250	1,271	678	450	450
Critical (15%)	344	275	300	300	300	300	575	2,092	783	450	450	413

Revised Second Basis of Comparison 2 minus Revised Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	-2%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	-3%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5E.3.9. Clear Creek below Whiskeytown, Monthly Flow

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Revised Second Basis of Comparison												
Probability of Exceedance ^a												
10%	200	200	200	200	200	200	200	200	200	85	85	150
20%	200	200	200	200	200	200	200	200	200	85	85	150
30%	200	200	200	200	200	200	200	200	200	85	85	150
40%	200	200	200	200	200	200	200	200	200	85	85	150
50%	200	200	200	200	200	200	200	200	200	85	85	150
60%	200	200	200	200	200	200	200	200	200	85	85	150
70%	200	200	200	200	200	200	200	200	200	85	85	150
80%	200	200	200	200	200	200	200	200	150	85	85	150
90%	150	150	150	150	150	150	150	150	150	85	85	150
Long Term												
Full Simulation Period ^b	185	188	190	225	241	214	191	192	181	85	85	148
Water Year Types ^c												
Wet (32%)	200	200	200	309	356	272	200	200	200	85	85	150
Above Normal (16%)	181	182	188	192	196	196	196	200	200	85	85	150
Below Normal (13%)	195	195	195	195	195	195	195	195	191	85	85	150
Dry (24%)	178	184	188	190	190	190	190	190	183	85	85	150
Critical (15%)	163	167	167	167	167	167	167	167	111	85	85	133

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Revised Second Basis of Comparison 2												
Probability of Exceedance ^a												
10%	200	200	200	200	200	200	200	200	200	85	85	150
20%	200	200	200	200	200	200	200	200	200	85	85	150
30%	200	200	200	200	200	200	200	200	200	85	85	150
40%	200	200	200	200	200	200	200	200	200	85	85	150
50%	200	200	200	200	200	200	200	200	200	85	85	150
60%	200	200	200	200	200	200	200	200	200	85	85	150
70%	200	200	200	200	200	200	200	200	200	85	85	150
80%	200	200	200	200	200	200	200	200	150	85	85	150
90%	150	150	150	150	150	150	150	150	150	85	85	150
Long Term												
Full Simulation Period ^b	185	188	190	225	241	214	191	192	181	85	85	148
Water Year Types ^c												
Wet (32%)	200	200	200	309	356	272	200	200	200	85	85	150
Above Normal (16%)	181	182	188	192	196	196	196	200	200	85	85	150
Below Normal (13%)	195	195	195	195	195	195	195	195	191	85	85	150
Dry (24%)	178	184	188	190	190	190	190	190	183	85	85	150
Critical (15%)	163	167	167	167	167	167	167	167	111	85	85	133

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Revised Second Basis of Comparison 2 minus Revised Second Basis of Comparison												
Probability of Exceedance ^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types ^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5E.3.10. Sacramento River d/s of Keswick Dam, Monthly Flow

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Revised Second Basis of Comparison												
Probability of Exceedance^a												
10%	8,508	7,567	19,509	20,470	31,560	18,571	10,172	10,229	14,458	15,000	12,700	8,243
20%	7,898	6,796	11,485	15,018	21,412	12,718	8,215	9,227	13,000	15,000	11,702	6,412
30%	7,349	5,700	6,189	8,978	12,892	8,359	6,962	8,481	12,266	15,000	11,187	5,953
40%	6,205	5,230	4,374	4,500	5,302	4,500	6,305	8,011	11,426	14,606	10,732	5,680
50%	5,651	4,873	4,016	4,184	4,500	4,500	5,732	7,437	11,089	14,001	10,234	5,500
60%	5,260	4,407	3,976	3,798	3,656	3,872	5,144	7,099	10,345	13,365	9,823	5,180
70%	4,873	4,180	3,680	3,251	3,250	3,250	4,500	6,543	9,975	12,759	9,256	4,650
80%	4,295	4,000	3,274	3,250	3,250	3,250	4,500	6,091	9,205	11,861	9,034	4,318
90%	4,000	3,502	3,250	3,250	3,250	3,250	3,713	5,573	8,400	10,741	8,139	4,013
Long Term												
Full Simulation Period ^b	6,057	5,625	7,681	9,345	11,729	8,578	6,745	7,749	11,210	13,425	10,387	5,801
Water Year Types^c												
Wet (32%)	6,381	6,742	14,046	18,182	20,764	16,037	8,702	8,399	10,291	13,215	11,128	7,264
Above Normal (16%)	5,874	5,793	7,473	8,992	17,811	8,881	6,317	7,819	11,981	14,792	11,359	5,970
Below Normal (13%)	6,540	5,702	4,124	4,784	7,119	5,064	6,094	8,130	12,326	14,507	11,942	5,416
Dry (24%)	6,237	4,756	3,898	4,123	3,573	3,701	5,074	7,334	11,725	13,439	8,903	4,782
Critical (15%)	4,808	4,399	3,682	3,463	3,382	3,440	6,347	6,608	10,486	11,383	8,776	4,501

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Revised Second Basis of Comparison 2												
Probability of Exceedance^a												
10%	8,508	7,568	19,508	20,466	31,555	18,571	10,172	10,229	14,462	15,000	12,690	8,199
20%	8,021	6,797	11,488	15,013	21,412	12,718	8,215	9,227	12,983	15,000	11,701	6,412
30%	7,345	5,700	6,102	8,978	12,849	8,359	6,962	8,481	12,266	15,000	11,187	5,952
40%	6,205	5,230	4,373	4,500	5,297	4,500	6,305	8,011	11,426	14,606	10,734	5,674
50%	5,649	4,873	4,020	4,184	4,500	4,500	5,732	7,445	11,090	14,001	10,234	5,501
60%	5,261	4,407	3,976	3,798	3,654	3,872	5,144	7,099	10,345	13,365	9,823	5,180
70%	4,870	4,180	3,677	3,251	3,250	3,250	4,500	6,543	9,975	12,763	9,265	4,650
80%	4,303	4,000	3,274	3,250	3,250	3,250	4,500	6,091	9,205	11,861	9,033	4,318
90%	4,000	3,502	3,250	3,250	3,250	3,250	3,713	5,573	8,400	10,740	8,139	4,013
Long Term												
Full Simulation Period ^b	6,062	5,626	7,679	9,344	11,727	8,578	6,745	7,748	11,212	13,425	10,389	5,801
Water Year Types^c												
Wet (32%)	6,382	6,743	14,043	18,180	20,764	16,037	8,702	8,401	10,291	13,216	11,128	7,264
Above Normal (16%)	5,900	5,796	7,456	8,992	17,809	8,878	6,317	7,819	11,985	14,792	11,362	5,966
Below Normal (13%)	6,542	5,700	4,124	4,784	7,110	5,064	6,092	8,132	12,333	14,507	11,943	5,415
Dry (24%)	6,236	4,755	3,904	4,123	3,572	3,701	5,075	7,327	11,724	13,438	8,910	4,784
Critical (15%)	4,814	4,405	3,682	3,465	3,382	3,440	6,347	6,608	10,488	11,387	8,776	4,501

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Revised Second Basis of Comparison 2 minus Revised Second Basis of Comparison												
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%
20%	2%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5E.3.11. Feather River d/s of Thermalito Afterbay, Monthly Flow

Revised Second Basis of Comparison

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,000	2,500	4,835	14,314	19,368	14,789	8,396	8,275	7,856	9,422	7,708	5,582
20%	4,000	2,500	3,418	3,405	11,381	11,022	3,686	6,274	6,941	9,008	6,567	5,294
30%	4,000	2,154	2,155	1,700	6,094	7,843	2,757	5,155	6,254	8,564	5,571	4,549
40%	3,846	1,700	1,700	1,700	2,096	5,528	1,853	3,512	5,303	7,944	4,680	3,736
50%	3,257	1,700	1,700	1,700	1,700	2,556	1,251	2,546	4,170	6,005	3,576	2,541
60%	2,524	1,700	1,700	1,700	1,700	1,700	1,000	2,029	3,830	4,794	2,735	1,630
70%	1,907	1,700	1,700	1,200	1,700	1,700	1,000	1,368	3,414	3,703	2,365	1,194
80%	1,700	1,200	1,233	960	1,200	1,000	1,000	1,000	2,670	3,289	1,809	1,044
90%	1,200	900	947	900	900	800	853	1,000	1,896	2,030	1,206	1,000
Long Term												
Full Simulation Period ^b	2,883	1,975	3,118	4,822	5,809	6,464	3,131	4,034	4,728	6,028	4,104	3,030
Water Year Types^c												
Wet (32%)	3,088	2,647	5,483	11,721	12,717	13,752	6,587	7,095	4,508	6,870	4,216	3,247
Above Normal (16%)	2,619	1,600	2,558	2,517	5,107	8,076	2,259	3,064	4,892	8,869	6,442	4,473
Below Normal (13%)	3,268	1,918	1,782	1,582	3,049	2,066	1,394	3,522	6,283	7,619	4,328	3,469
Dry (24%)	2,761	1,611	1,960	1,360	1,497	1,323	1,191	2,421	4,994	4,330	3,640	2,475
Critical (15%)	2,572	1,582	1,754	1,108	1,317	1,523	1,410	1,609	3,159	2,495	1,898	1,521

Revised Second Basis of Comparison 2

Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,000	2,500	4,835	14,314	19,370	14,789	8,396	8,275	7,859	9,427	7,721	5,582
20%	4,000	2,500	3,419	3,408	11,382	11,022	3,686	6,268	6,944	9,031	6,566	5,294
30%	4,000	2,153	2,155	1,700	6,094	7,843	2,757	5,155	6,254	8,559	5,571	4,553
40%	3,845	1,700	1,700	1,700	2,090	5,528	1,853	3,528	5,318	7,938	4,666	3,738
50%	3,257	1,700	1,700	1,700	1,700	2,436	1,251	2,547	4,173	6,001	3,573	2,544
60%	2,644	1,700	1,700	1,700	1,700	1,700	1,000	2,030	3,830	4,785	2,724	1,632
70%	1,932	1,700	1,700	1,200	1,700	1,700	1,000	1,368	3,418	3,704	2,364	1,197
80%	1,700	1,200	1,233	990	1,200	1,000	1,000	1,000	2,670	3,285	1,942	1,044
90%	1,200	900	947	900	900	800	853	1,000	1,896	2,030	1,206	1,000
Long Term												
Full Simulation Period ^b	2,897	1,974	3,115	4,822	5,808	6,457	3,131	4,034	4,727	6,021	4,108	3,032
Water Year Types^c												
Wet (32%)	3,087	2,647	5,484	11,722	12,717	13,752	6,588	7,093	4,509	6,866	4,210	3,245
Above Normal (16%)	2,680	1,600	2,560	2,517	5,106	8,033	2,259	3,064	4,898	8,869	6,439	4,473
Below Normal (13%)	3,268	1,918	1,782	1,582	3,046	2,066	1,394	3,522	6,270	7,583	4,327	3,480
Dry (24%)	2,763	1,613	1,960	1,360	1,498	1,323	1,191	2,425	4,993	4,328	3,648	2,480
Critical (15%)	2,604	1,577	1,726	1,111	1,317	1,523	1,410	1,609	3,160	2,492	1,932	1,520

Revised Second Basis of Comparison 2 minus Revised Second Basis of Comparison

Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	-5%	0%	0%	0%	0%	0%	0%
60%	5%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	3%	0%	0%	0%	0%	0%	0%	7%	0%
90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	2%	0%	0%	0%	0%	-1%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	1%	0%	-2%	0%	0%	0%	0%	0%	0%	0%	2%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Appendix 5E: Sensitivity Analysis - Revised Second Basis of Comparison with no Fremont Weir Notch

Table 5E.3.12. Fremont Weir, Monthly Spills

Revised Second Basis of Comparison												
Statistic	Monthly Spills (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	100	100	10,536	30,202	45,235	18,332	5,859	100	100	0	0	100
20%	100	100	3,758	10,563	13,794	7,393	4,170	100	100	0	0	100
30%	100	100	1,561	5,232	8,155	5,246	957	100	100	0	0	100
40%	100	100	532	2,826	5,590	3,433	341	100	100	0	0	100
50%	100	100	188	1,638	3,268	2,065	119	100	100	0	0	100
60%	100	100	100	851	2,291	1,093	100	100	100	0	0	100
70%	100	100	100	153	1,142	482	100	100	100	0	0	100
80%	100	100	100	100	184	201	100	100	100	0	0	100
90%	100	100	100	100	100	100	100	100	100	0	0	100
Long Term												
Full Simulation Period ^b	113	386	3,702	9,547	13,182	7,929	2,213	160	104	0	0	100
Water Year Types ^c												
Wet (32%)	142	1,002	9,898	25,426	30,534	18,973	5,611	289	113	0	0	100
Above Normal (16%)	100	100	2,664	6,376	15,112	8,541	1,765	100	100	0	0	100
Below Normal (13%)	100	100	262	1,251	3,971	1,167	292	100	100	0	0	100
Dry (24%)	100	100	346	931	2,024	1,405	410	100	100	0	0	100
Critical (15%)	100	100	149	542	536	407	106	100	100	0	0	100

Revised Second Basis of Comparison 2												
Statistic	Monthly Spills (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0	0	7,600	28,436	44,415	16,589	475	0	0	0	0	0
20%	0	0	504	7,797	12,992	5,175	0	0	0	0	0	0
30%	0	0	0	2,064	6,252	595	0	0	0	0	0	0
40%	0	0	0	0	1,634	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	14	287	2,870	8,218	11,714	6,350	1,075	61	4	0	0	0
Water Year Types ^c												
Wet (32%)	43	907	8,057	23,791	28,683	17,011	3,300	192	14	0	0	0
Above Normal (16%)	0	0	1,990	3,956	13,631	5,957	138	0	0	0	0	0
Below Normal (13%)	0	0	0	0	2,263	3	0	0	0	0	0	0
Dry (24%)	0	0	0	196	634	48	26	0	0	0	0	0
Critical (15%)	0	0	0	0	0	0	0	0	0	0	0	0

Revised Second Basis of Comparison 2 minus Revised Second Basis of Comparison												
Statistic	Monthly Spills (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-100%	-100%	-28%	-6%	-2%	-10%	-92%	-100%	-100%	0%	0%	-100%
20%	-100%	-100%	-87%	-26%	-6%	-30%	-100%	-100%	-100%	0%	0%	-100%
30%	-100%	-100%	-100%	-61%	-23%	-89%	-100%	-100%	-100%	0%	0%	-100%
40%	-100%	-100%	-100%	-100%	-71%	-100%	-100%	-100%	-100%	0%	0%	-100%
50%	-100%	-100%	-100%	-100%	-100%	-100%	-100%	-100%	-100%	0%	0%	-100%
60%	-100%	-100%	-100%	-100%	-100%	-100%	-100%	-100%	-100%	0%	0%	-100%
70%	-100%	-100%	-100%	-100%	-100%	-100%	-100%	-100%	-100%	0%	0%	-100%
80%	-100%	-100%	-100%	-100%	-100%	-100%	-100%	-100%	-100%	0%	0%	-100%
90%	-100%	-100%	-100%	-100%	-100%	-100%	-100%	-100%	-100%	0%	0%	-100%
Long Term												
Full Simulation Period ^b	-88%	-26%	-22%	-14%	-11%	-20%	-51%	-62%	-96%	0%	0%	-100%
Water Year Types ^c												
Wet (32%)	-70%	-9%	-19%	-6%	-6%	-10%	-41%	-34%	-88%	0%	0%	-100%
Above Normal (16%)	-100%	-100%	-25%	-38%	-10%	-30%	-92%	-100%	-100%	0%	0%	-100%
Below Normal (13%)	-100%	-100%	-100%	-100%	-43%	-100%	-100%	-100%	-100%	0%	0%	-100%
Dry (24%)	-100%	-100%	-100%	-79%	-69%	-97%	-94%	-100%	-100%	0%	0%	-100%
Critical (15%)	-100%	-100%	-100%	-100%	-100%	-100%	-100%	-100%	-100%	0%	0%	-100%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5E.3.13. American River d/s of Nimbus Dam, Monthly Flow

Revised Second Basis of Comparison												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,967	3,951	9,359	12,160	14,655	9,754	6,737	7,450	4,652	5,000	3,200	1,766
20%	1,500	3,208	4,325	7,873	10,804	6,804	5,084	4,486	3,799	5,000	2,779	1,546
30%	1,500	2,078	2,528	5,706	7,391	5,044	4,483	3,543	3,623	4,965	2,299	1,533
40%	1,500	1,925	2,000	3,592	5,756	4,172	3,491	2,851	3,235	4,227	1,968	1,533
50%	1,500	1,827	2,000	1,750	3,739	3,042	2,499	2,060	2,954	3,616	1,750	1,533
60%	1,500	1,683	1,921	1,700	2,602	2,015	2,084	1,750	2,267	2,923	1,750	1,533
70%	1,389	1,438	1,676	1,700	1,445	1,747	1,750	1,614	1,916	2,515	1,659	1,493
80%	994	1,116	1,172	1,359	1,264	1,012	1,146	1,079	1,715	2,373	1,003	800
90%	800	800	800	819	978	800	800	800	1,070	1,377	800	800
Long Term												
Full Simulation Period ^b	1,461	2,384	3,819	5,098	6,026	4,282	3,390	3,085	3,012	3,445	1,905	1,407
Water Year Types^c												
Wet (32%)	1,666	3,308	7,234	10,515	10,615	7,209	5,522	5,541	4,239	3,582	2,611	1,749
Above Normal (16%)	1,269	2,552	3,616	5,637	7,965	6,117	3,572	2,527	2,973	4,780	1,902	1,553
Below Normal (13%)	1,656	2,274	2,654	2,356	5,177	2,187	2,471	1,914	2,895	4,586	1,752	1,205
Dry (24%)	1,321	1,682	1,603	1,572	2,313	2,377	2,209	1,947	2,426	3,001	1,466	1,223
Critical (15%)	1,279	1,469	1,400	1,171	950	1,047	1,383	1,340	1,479	1,395	1,249	1,002

Revised Second Basis of Comparison 2												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1,967	3,951	9,359	12,160	14,655	9,754	6,737	7,450	4,652	5,000	3,200	1,766
20%	1,500	3,207	4,325	7,873	10,804	6,804	5,084	4,486	3,799	5,000	2,779	1,546
30%	1,500	2,078	2,528	5,703	7,391	5,044	4,483	3,543	3,623	4,946	2,299	1,533
40%	1,500	1,925	2,000	3,591	5,756	4,172	3,491	2,851	3,235	4,228	1,968	1,533
50%	1,500	1,827	2,000	1,765	3,739	3,041	2,500	2,061	2,955	3,616	1,750	1,533
60%	1,500	1,683	1,921	1,700	2,602	2,015	2,084	1,750	2,267	2,923	1,750	1,533
70%	1,388	1,438	1,679	1,700	1,445	1,747	1,750	1,616	1,917	2,515	1,659	1,493
80%	994	1,110	1,171	1,359	1,264	1,010	1,133	1,079	1,716	2,373	1,003	800
90%	800	800	800	819	978	800	800	800	1,066	1,381	800	800
Long Term												
Full Simulation Period ^b	1,461	2,384	3,819	5,100	6,026	4,282	3,389	3,086	3,012	3,444	1,904	1,407
Water Year Types^c												
Wet (32%)	1,665	3,307	7,234	10,514	10,615	7,209	5,522	5,541	4,239	3,583	2,611	1,749
Above Normal (16%)	1,269	2,553	3,616	5,648	7,965	6,117	3,572	2,527	2,975	4,780	1,902	1,553
Below Normal (13%)	1,656	2,274	2,654	2,356	5,177	2,187	2,465	1,915	2,893	4,581	1,751	1,205
Dry (24%)	1,321	1,682	1,604	1,572	2,313	2,377	2,209	1,947	2,426	3,001	1,466	1,223
Critical (15%)	1,281	1,469	1,400	1,171	950	1,047	1,383	1,341	1,477	1,395	1,249	1,002

Revised Second Basis of Comparison 2 minus Revised Second Basis of Comparison												
Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	0%	-1%	0%	0%	0%	0%	-1%	0%	0%	0%	0%	0%
90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (32%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (15%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5E.3.14. Sacramento River at Freeport, Monthly Flow

Revised Second Basis of Comparison												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	14,551	22,359	54,045	64,879	70,451	63,654	46,240	38,579	20,776	23,195	16,663	15,098
20%	14,090	15,039	34,473	56,266	61,709	51,427	32,544	27,639	18,975	21,635	15,939	14,531
30%	13,193	13,786	22,326	41,578	51,524	41,506	22,932	17,452	18,150	20,277	15,193	14,129
40%	11,535	13,341	18,577	26,629	45,616	29,974	19,982	15,203	16,964	19,565	14,570	13,918
50%	10,865	12,102	15,606	23,009	33,290	24,772	16,394	13,797	15,808	18,216	13,980	13,211
60%	10,117	11,213	14,404	18,460	24,623	20,971	12,918	12,876	14,539	16,370	12,432	12,035
70%	9,064	10,188	12,929	15,002	19,808	18,571	11,683	12,087	13,047	14,608	10,714	9,785
80%	8,007	8,873	10,823	13,487	16,579	15,219	11,109	11,037	12,359	13,049	9,752	8,533
90%	7,029	7,552	9,350	11,866	14,216	11,491	10,200	9,036	11,481	9,999	8,703	7,301
Long Term												
Full Simulation Period ^b	11,166	14,169	23,197	31,223	37,970	31,864	22,160	18,740	16,877	17,261	13,039	12,099
Water Year Types^c												
Wet (32%)	12,847	18,563	38,684	50,414	56,964	48,443	35,068	30,178	21,009	19,004	14,907	14,667
Above Normal (16%)	10,044	15,450	24,213	39,681	47,790	42,769	24,411	18,103	16,671	21,742	15,918	14,124
Below Normal (13%)	12,260	14,350	15,660	19,252	31,672	19,432	14,555	14,839	17,909	20,529	14,052	12,119
Dry (24%)	10,515	10,941	13,654	17,397	23,786	21,469	15,030	12,638	14,681	14,800	10,736	10,279
Critical (15%)	8,820	8,470	11,351	14,500	15,588	12,846	10,613	8,393	10,858	9,733	8,780	7,353

Revised Second Basis of Comparison 2												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	14,651	22,458	55,976	65,447	70,579	63,789	51,294	38,678	20,876	23,228	16,663	15,196
20%	14,190	15,138	36,295	58,195	63,665	55,064	36,926	27,738	19,001	21,635	15,939	14,631
30%	13,290	13,884	23,779	43,298	54,603	45,366	23,699	17,552	18,253	20,275	15,190	14,229
40%	11,635	13,441	18,903	29,560	46,582	33,968	20,452	15,302	17,073	19,252	14,568	14,018
50%	10,964	12,201	16,092	24,328	36,049	26,279	16,499	13,897	15,909	18,229	13,976	13,338
60%	10,191	11,313	14,562	19,337	26,819	22,007	13,114	12,983	14,653	16,368	12,432	12,139
70%	9,213	10,320	13,046	15,141	20,860	19,568	11,783	12,187	13,147	14,602	10,712	9,887
80%	8,265	8,973	10,922	13,587	16,690	15,554	11,209	11,137	12,459	13,048	9,750	8,631
90%	7,130	7,652	9,450	11,989	14,317	11,591	10,300	9,136	11,581	9,999	8,703	7,397
Long Term												
Full Simulation Period ^b	11,285	14,267	24,020	32,553	39,431	33,434	23,297	18,838	16,977	17,253	13,041	12,199
Water Year Types^c												
Wet (32%)	12,946	18,658	40,520	52,046	58,813	50,404	37,375	30,275	21,109	19,007	14,908	14,767
Above Normal (16%)	10,230	15,551	24,861	42,109	49,311	45,306	26,037	18,203	16,783	21,741	15,917	14,219
Below Normal (13%)	12,361	14,448	15,920	20,503	33,322	20,596	14,840	14,942	18,001	20,474	14,040	12,219
Dry (24%)	10,616	11,042	14,007	18,132	25,157	22,825	15,413	12,733	14,778	14,796	10,751	10,386
Critical (15%)	8,960	8,570	11,473	15,048	16,123	13,253	10,719	8,492	10,958	9,732	8,779	7,453

Revised Second Basis of Comparison 2 minus Revised Second Basis of Comparison												
Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1%	0%	4%	1%	0%	0%	11%	0%	0%	0%	0%	1%
20%	1%	1%	5%	3%	3%	7%	13%	0%	0%	0%	0%	1%
30%	1%	1%	7%	4%	6%	9%	3%	1%	1%	0%	0%	1%
40%	1%	1%	2%	11%	2%	13%	2%	1%	1%	-2%	0%	1%
50%	1%	1%	3%	6%	8%	6%	1%	1%	1%	0%	0%	1%
60%	1%	1%	1%	5%	9%	5%	2%	1%	1%	0%	0%	1%
70%	2%	1%	1%	1%	5%	5%	1%	1%	1%	0%	0%	1%
80%	3%	1%	1%	1%	1%	2%	1%	1%	1%	0%	0%	1%
90%	1%	1%	1%	1%	1%	1%	1%	1%	1%	0%	0%	1%
Long Term												
Full Simulation Period ^b	1%	1%	4%	4%	4%	5%	5%	1%	1%	0%	0%	1%
Water Year Types^c												
Wet (32%)	1%	1%	5%	3%	3%	4%	7%	0%	0%	0%	0%	1%
Above Normal (16%)	2%	1%	3%	6%	3%	6%	7%	1%	1%	0%	0%	1%
Below Normal (13%)	1%	1%	2%	6%	5%	6%	2%	1%	1%	0%	0%	1%
Dry (24%)	1%	1%	3%	4%	6%	6%	3%	1%	1%	0%	0%	1%
Critical (15%)	2%	1%	1%	4%	3%	3%	1%	1%	1%	0%	0%	1%

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5E.3.15. Yolo Bypass, Monthly Flow

Revised Second Basis of Comparison												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	164	575	15,106	37,291	53,011	25,260	10,346	335	168	48	183	240
20%	162	245	6,371	16,098	21,931	11,070	7,372	178	168	48	55	159
30%	160	146	2,509	8,217	12,355	8,556	2,043	173	168	48	55	159
40%	154	110	803	5,020	10,223	5,190	499	170	168	48	55	159
50%	147	108	496	2,405	5,513	2,988	272	168	167	48	55	159
60%	142	105	259	970	3,254	1,402	229	165	167	48	55	159
70%	132	100	146	470	1,202	754	211	163	166	48	55	157
80%	116	100	107	167	345	225	186	159	164	48	55	155
90%	106	100	100	123	129	149	173	153	162	48	54	152
Long Term												
Full Simulation Period ^b	186	574	5,171	12,736	17,111	10,707	3,656	311	185	48	101	175
Water Year Types^c												
Wet (32%)	227	1,354	13,411	32,911	38,549	25,268	8,882	560	227	48	147	173
Above Normal (16%)	137	345	4,161	9,622	19,789	11,595	3,242	273	166	48	92	165
Below Normal (13%)	246	299	470	1,969	5,903	1,665	546	169	166	48	130	192
Dry (24%)	156	131	585	1,582	3,393	2,185	908	175	167	48	61	170
Critical (15%)	145	124	365	857	900	687	210	167	165	48	55	188

Revised Second Basis of Comparison 2												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	64	475	12,246	36,406	53,010	23,707	6,806	236	68	48	183	140
20%	62	145	3,079	13,238	20,732	8,689	3,203	78	68	48	55	59
30%	60	46	973	5,270	9,602	3,589	635	73	68	48	55	59
40%	54	10	342	2,005	7,094	2,154	190	70	68	48	55	59
50%	47	8	165	540	2,456	917	135	68	67	48	55	59
60%	42	5	60	327	729	279	111	65	67	48	55	59
70%	32	0	20	80	261	115	88	63	66	48	55	57
80%	17	0	0	32	82	45	78	59	64	48	55	55
90%	6	0	0	7	19	7	56	53	62	48	54	52
Long Term												
Full Simulation Period ^b	86	476	4,342	11,408	15,651	9,129	2,518	212	86	48	101	75
Water Year Types^c												
Wet (32%)	127	1,259	11,572	31,277	36,700	23,307	6,575	463	128	48	147	73
Above Normal (16%)	38	245	3,498	7,204	18,311	9,012	1,616	173	66	48	92	65
Below Normal (13%)	146	199	208	718	4,240	501	253	69	66	48	130	92
Dry (24%)	56	31	238	846	2,005	828	525	75	67	48	61	70
Critical (15%)	45	24	216	314	365	279	105	67	65	48	55	88

Revised Second Basis of Comparison 2 minus Revised Second Basis of Comparison												
Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-61%	-17%	-19%	-2%	0%	-6%	-34%	-30%	-60%	0%	0%	-42%
20%	-62%	-41%	-52%	-18%	-5%	-22%	-57%	-56%	-60%	0%	0%	-63%
30%	-63%	-69%	-61%	-36%	-22%	-58%	-69%	-58%	-60%	0%	0%	-63%
40%	-65%	-91%	-57%	-60%	-31%	-59%	-62%	-59%	-60%	0%	0%	-63%
50%	-68%	-92%	-67%	-78%	-55%	-69%	-50%	-60%	-60%	0%	0%	-63%
60%	-70%	-95%	-77%	-66%	-78%	-80%	-51%	-61%	-60%	0%	0%	-63%
70%	-76%	-100%	-86%	-83%	-78%	-85%	-58%	-61%	-60%	0%	0%	-64%
80%	-85%	-100%	-100%	-81%	-76%	-80%	-58%	-63%	-61%	0%	0%	-65%
90%	-94%	-100%	-100%	-94%	-85%	-96%	-68%	-65%	-62%	0%	0%	-66%
Long Term												
Full Simulation Period ^b	-54%	-17%	-16%	-10%	-9%	-15%	-31%	-32%	-54%	0%	0%	-57%
Water Year Types^c												
Wet (32%)	-44%	-7%	-14%	-5%	-5%	-8%	-26%	-17%	-44%	0%	0%	-58%
Above Normal (16%)	-72%	-29%	-16%	-25%	-7%	-22%	-50%	-37%	-60%	0%	0%	-61%
Below Normal (13%)	-41%	-33%	-56%	-64%	-28%	-70%	-54%	-59%	-60%	0%	0%	-52%
Dry (24%)	-64%	-76%	-59%	-46%	-41%	-62%	-42%	-57%	-60%	0%	0%	-59%
Critical (15%)	-69%	-81%	-41%	-63%	-59%	-59%	-50%	-60%	-61%	0%	0%	-53%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Appendix 5E: Sensitivity Analysis - Revised Second Basis of Comparison with no Fremont Weir Notch

Table 5E.3.16. Sacramento River at Rio Vista, Monthly Flow

Revised Second Basis of Comparison												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	8,459	16,168	59,604	92,211	116,167	75,834	51,782	32,159	12,425	13,392	9,476	8,745
20%	8,183	9,840	34,954	61,221	73,778	55,512	33,674	22,346	11,245	12,430	9,155	8,380
30%	7,549	8,910	18,359	44,979	56,260	41,456	20,337	13,432	10,594	11,499	8,516	8,130
40%	6,476	8,546	13,684	26,298	48,706	29,686	16,926	11,454	9,811	10,960	8,025	7,948
50%	6,002	7,675	11,332	19,987	32,704	23,249	12,770	10,161	9,037	10,125	7,654	7,450
60%	5,495	6,993	10,012	15,044	23,444	18,024	9,786	9,537	8,236	8,857	6,551	6,677
70%	4,778	6,275	8,684	11,678	17,211	16,060	8,764	8,824	7,064	7,639	5,379	5,305
80%	4,057	5,284	7,025	9,829	13,407	12,147	8,230	7,916	6,689	6,606	4,772	4,252
90%	3,427	4,334	5,914	8,722	11,278	8,663	7,375	6,205	6,140	4,513	3,929	3,460
Long Term												
Full Simulation Period ^b	6,332	10,109	23,121	38,692	49,363	37,209	21,381	14,750	10,295	9,421	7,013	6,738
Water Year Types ^c												
Wet (32%)	7,656	14,701	45,362	76,406	87,481	66,334	37,923	24,956	14,319	10,606	8,326	8,455
Above Normal (16%)	5,503	10,915	22,930	43,450	60,792	47,545	22,896	14,185	9,632	12,460	8,973	8,077
Below Normal (13%)	7,045	9,835	11,545	16,974	32,611	17,199	11,548	11,149	10,482	11,626	7,741	6,775
Dry (24%)	5,767	6,823	9,877	14,836	23,168	19,626	12,445	9,307	8,227	7,775	5,404	5,497
Critical (15%)	4,650	5,015	7,821	11,491	13,412	10,555	7,804	5,622	5,568	4,282	4,059	3,603

Revised Second Basis of Comparison 2												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	8,428	16,142	59,025	92,089	116,148	75,586	51,297	32,145	12,395	13,415	9,476	8,712
20%	8,151	9,817	34,545	60,928	73,557	55,099	33,255	22,332	11,216	12,430	9,155	8,348
30%	7,516	8,884	17,961	44,810	55,851	40,962	20,159	13,419	10,567	11,499	8,516	8,098
40%	6,444	8,520	13,599	27,198	48,210	29,162	16,842	11,440	9,789	10,794	8,031	7,918
50%	5,971	7,648	11,239	19,694	32,308	22,975	12,756	10,140	9,008	10,134	7,661	7,436
60%	5,445	6,968	9,965	14,823	23,422	17,897	9,762	9,530	8,217	8,856	6,551	6,648
70%	4,772	6,250	8,649	11,658	17,060	15,945	8,751	8,811	7,034	7,634	5,377	5,273
80%	4,138	5,258	7,001	9,809	13,388	12,103	8,217	7,886	6,659	6,607	4,766	4,219
90%	3,395	4,308	5,892	8,693	11,265	8,650	7,362	6,192	6,111	4,513	3,929	3,426
Long Term												
Full Simulation Period ^b	6,316	10,086	22,983	38,581	49,172	36,995	21,230	14,736	10,267	9,416	7,015	6,708
Water Year Types ^c												
Wet (32%)	7,625	14,677	45,087	76,184	87,237	66,076	37,619	24,943	14,295	10,608	8,326	8,423
Above Normal (16%)	5,537	10,894	22,791	43,255	60,634	47,165	22,682	14,172	9,611	12,460	8,972	8,042
Below Normal (13%)	7,014	9,810	11,490	16,939	32,379	17,045	11,502	11,140	10,447	11,592	7,733	6,744
Dry (24%)	5,737	6,798	9,823	14,788	22,971	19,447	12,394	9,290	8,196	7,773	5,415	5,469
Critical (15%)	4,647	4,994	7,765	11,534	13,341	10,502	7,790	5,609	5,539	4,281	4,058	3,581

Revised Second Basis of Comparison 2 minus Revised Second Basis of Comparison												
Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0%	0%	-1%	0%	0%	0%	-1%	0%	0%	0%	0%	0%
20%	0%	0%	-1%	0%	0%	-1%	-1%	0%	0%	0%	0%	0%
30%	0%	0%	-2%	0%	-1%	-1%	-1%	0%	0%	0%	0%	0%
40%	0%	0%	-1%	3%	-1%	-2%	0%	0%	0%	-2%	0%	0%
50%	-1%	0%	-1%	-1%	-1%	-1%	0%	0%	0%	0%	0%	0%
60%	-1%	0%	0%	-1%	0%	-1%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	-1%	-1%	0%	0%	0%	0%	0%	-1%
80%	2%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%
90%	-1%	-1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	-1%
Long Term												
Full Simulation Period ^b	0%	0%	-1%	0%	0%	-1%	-1%	0%	0%	0%	0%	0%
Water Year Types ^c												
Wet (32%)	0%	0%	-1%	0%	0%	0%	-1%	0%	0%	0%	0%	0%
Above Normal (16%)	1%	0%	-1%	0%	0%	-1%	-1%	0%	0%	0%	0%	0%
Below Normal (13%)	0%	0%	0%	0%	-1%	-1%	0%	0%	0%	0%	0%	0%
Dry (24%)	-1%	0%	-1%	0%	-1%	-1%	0%	0%	0%	0%	0%	-1%
Critical (15%)	0%	0%	-1%	0%	-1%	-1%	0%	0%	-1%	0%	0%	-1%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 5E.3.17. San Joaquin River at Vernalis, Monthly Flow

Revised Second Basis of Comparison												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,058	3,088	4,931	11,054	17,256	15,467	14,774	14,101	9,720	6,052	2,996	3,315
20%	2,699	2,813	2,924	4,859	10,259	9,401	10,359	8,202	4,768	2,636	2,599	2,659
30%	2,470	2,631	2,462	3,635	6,228	7,841	8,536	5,452	3,364	1,988	1,896	2,484
40%	2,326	2,448	2,299	2,606	4,252	5,343	7,507	4,488	2,947	1,742	1,675	2,152
50%	2,089	2,342	2,226	2,481	3,420	3,825	6,018	3,916	2,205	1,503	1,499	1,934
60%	1,895	2,218	2,100	2,247	2,681	3,460	4,432	2,913	1,824	1,384	1,415	1,837
70%	1,697	2,100	1,988	2,070	2,379	2,870	3,224	2,493	1,420	1,170	1,322	1,743
80%	1,511	1,954	1,866	1,827	2,153	2,327	2,452	1,994	1,271	1,087	1,211	1,611
90%	1,338	1,753	1,671	1,638	1,931	2,115	1,813	1,564	1,085	941	1,099	1,503
Long Term												
Full Simulation Period ^b	2,200	2,673	3,455	5,082	6,806	7,116	7,330	5,903	4,350	2,668	1,876	2,266
Water Year Types^c												
Wet (23%)	2,472	3,596	6,642	11,484	16,260	16,444	15,398	14,493	12,009	6,823	3,227	3,582
Above Normal (24%)	2,234	2,469	2,712	4,887	6,916	7,376	8,371	5,184	3,310	1,997	1,976	2,348
Below Normal (10%)	2,052	2,330	3,742	3,561	3,837	4,077	5,974	3,968	2,025	1,478	1,455	1,847
Dry (16%)	2,305	2,644	2,306	2,421	2,623	3,227	3,656	2,625	1,661	1,266	1,362	1,783
Critical (27%)	1,926	2,205	1,952	1,854	2,092	2,228	2,079	1,780	1,114	951	1,077	1,490

Revised Second Basis of Comparison 2												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,058	3,088	4,931	11,054	17,256	15,467	14,774	14,101	9,720	6,052	2,996	3,315
20%	2,699	2,813	2,924	4,859	10,259	9,401	10,359	8,202	4,768	2,636	2,599	2,659
30%	2,470	2,631	2,462	3,635	6,228	7,841	8,536	5,452	3,364	1,988	1,896	2,484
40%	2,326	2,448	2,299	2,606	4,252	5,343	7,507	4,488	2,947	1,742	1,675	2,152
50%	2,089	2,342	2,226	2,481	3,420	3,825	6,018	3,916	2,205	1,503	1,499	1,934
60%	1,895	2,218	2,100	2,247	2,681	3,460	4,432	2,913	1,824	1,383	1,415	1,837
70%	1,697	2,100	1,988	2,070	2,379	2,870	3,224	2,493	1,420	1,169	1,322	1,743
80%	1,511	1,954	1,866	1,827	2,153	2,327	2,452	1,994	1,271	1,087	1,211	1,611
90%	1,338	1,753	1,671	1,638	1,931	2,115	1,813	1,564	1,085	941	1,099	1,503
Long Term												
Full Simulation Period ^b	2,200	2,673	3,455	5,082	6,806	7,116	7,330	5,903	4,350	2,668	1,876	2,266
Water Year Types^c												
Wet (23%)	2,472	3,596	6,642	11,484	16,260	16,444	15,398	14,493	12,009	6,823	3,227	3,582
Above Normal (24%)	2,234	2,469	2,712	4,887	6,916	7,376	8,371	5,184	3,310	1,997	1,976	2,348
Below Normal (10%)	2,052	2,330	3,742	3,561	3,837	4,077	5,974	3,968	2,025	1,478	1,455	1,847
Dry (16%)	2,305	2,644	2,306	2,421	2,623	3,227	3,656	2,625	1,661	1,266	1,362	1,783
Critical (27%)	1,926	2,205	1,952	1,854	2,092	2,228	2,079	1,780	1,114	951	1,077	1,490

Revised Second Basis of Comparison 2 minus Revised Second Basis of Comparison												
Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (23%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (10%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (27%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5E.3.18. San Joaquin River at Vernalis, Monthly EC

Revised Second Basis of Comparison												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	752	643	807	807	948	865	577	597	649	649	622	603
20%	714	611	784	781	911	824	524	572	645	648	603	584
30%	677	584	770	754	840	744	436	528	631	647	580	568
40%	642	572	758	723	790	686	383	493	606	638	571	552
50%	609	555	740	704	693	612	324	395	572	628	557	539
60%	570	538	730	691	631	499	303	363	500	617	543	520
70%	551	522	716	643	469	352	282	346	464	607	526	489
80%	522	495	691	572	316	306	261	294	420	587	451	478
90%	477	467	611	380	261	255	201	192	366	487	410	418
Long Term												
Full Simulation Period ^b	613	547	714	661	642	573	372	419	526	597	533	522
Water Year Types^c												
Wet (23%)	585	518	623	520	357	306	220	229	365	489	405	405
Above Normal (24%)	608	548	728	628	485	421	301	365	494	617	515	506
Below Normal (10%)	618	566	688	673	692	606	313	388	555	611	563	551
Dry (16%)	597	526	742	725	818	698	413	502	593	635	579	559
Critical (27%)	648	577	772	772	909	854	563	594	643	645	623	607

Revised Second Basis of Comparison 2												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	752	643	807	807	948	865	577	597	649	649	622	603
20%	714	611	784	781	911	824	524	572	645	648	603	584
30%	677	584	770	754	840	744	436	528	631	647	580	568
40%	642	572	758	723	790	686	383	493	606	638	571	552
50%	609	555	740	704	693	612	324	395	572	628	557	539
60%	570	538	730	691	631	499	303	363	500	617	543	520
70%	551	522	716	643	469	352	282	346	464	607	526	489
80%	522	495	691	572	316	306	261	294	420	587	451	478
90%	477	467	611	380	261	255	201	192	366	487	410	418
Long Term												
Full Simulation Period ^b	613	547	714	661	642	573	372	419	526	597	533	522
Water Year Types^c												
Wet (23%)	585	518	623	520	357	306	220	229	365	489	405	405
Above Normal (24%)	608	548	728	628	485	421	301	365	494	617	515	506
Below Normal (10%)	618	566	688	673	692	606	313	388	555	611	563	551
Dry (16%)	597	526	742	725	818	698	413	502	593	635	579	559
Critical (27%)	648	577	772	772	909	854	563	594	643	645	623	607

Revised Second Basis of Comparison 2 minus Revised Second Basis of Comparison												
Statistic	Monthly EC (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (23%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (10%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (27%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Table 5E.3.19. Stanislaus River below Goodwin, Monthly Flow

Revised Second Basis of Comparison												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	350	399	400	400	1,825	999	1,500	1,500	1,502	491	319	300
20%	349	356	358	359	863	400	1,500	1,498	1,243	313	300	300
30%	318	334	340	336	400	344	1,429	1,380	948	300	285	281
40%	260	305	323	318	364	312	1,241	1,134	713	296	283	250
50%	193	246	280	250	339	267	879	855	399	283	283	249
60%	146	217	230	183	304	200	649	725	300	271	283	249
70%	123	207	214	152	239	159	517	612	265	265	283	249
80%	115	202	206	136	176	140	462	507	255	265	283	249
90%	104	188	188	122	133	123	403	439	255	265	283	249
Long Term												
Full Simulation Period ^b	250	340	429	530	748	593	958	984	830	433	386	391
Water Year Types^c												
Wet (23%)	334	581	884	1,038	1,692	1,597	1,511	1,556	1,813	860	729	857
Above Normal (24%)	248	269	331	666	712	484	1,051	1,062	986	352	287	268
Below Normal (10%)	254	306	306	336	532	292	1,087	1,021	414	269	283	261
Dry (16%)	245	282	290	253	387	185	686	743	346	276	283	249
Critical (27%)	181	242	252	203	256	174	511	548	278	291	277	233

Revised Second Basis of Comparison 2												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	350	399	400	400	1,825	999	1,500	1,500	1,502	491	319	300
20%	349	356	358	359	863	400	1,500	1,498	1,243	313	300	300
30%	318	334	340	336	400	344	1,429	1,380	948	300	285	281
40%	260	305	323	318	364	312	1,241	1,134	713	296	283	250
50%	193	246	280	250	339	267	879	855	399	283	283	249
60%	146	217	230	183	304	200	649	725	300	271	283	249
70%	123	207	214	152	239	159	517	612	265	265	283	249
80%	115	202	206	136	176	140	462	507	255	265	283	249
90%	104	188	188	122	133	123	403	439	255	265	283	249
Long Term												
Full Simulation Period ^b	250	340	429	530	748	593	958	984	830	433	386	391
Water Year Types^c												
Wet (23%)	334	581	884	1,038	1,692	1,597	1,511	1,556	1,813	860	729	857
Above Normal (24%)	248	269	331	666	712	484	1,051	1,062	986	352	287	268
Below Normal (10%)	254	306	306	336	532	292	1,087	1,021	414	269	283	261
Dry (16%)	245	282	290	253	387	185	686	743	346	276	283	249
Critical (27%)	181	242	252	203	256	174	511	548	278	291	277	233

Revised Second Basis of Comparison 2 minus Revised Second Basis of Comparison												
Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (23%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (10%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (27%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
b Based on the 82-year simulation period.
c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Appendix 5E: Sensitivity Analysis - Revised Second Basis of Comparison with no Fremont Weir Notch

Table 5E.3.20. Stanislaus River at Mouth, Monthly Flow

Revised Second Basis of Comparison												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	653	567	590	624	2,437	1,243	1,824	1,680	1,791	932	588	706
20%	577	482	480	506	987	615	1,626	1,588	1,545	564	488	506
30%	491	441	431	462	560	531	1,495	1,515	1,261	499	458	473
40%	424	409	382	434	498	458	1,303	1,285	1,041	443	445	446
50%	377	386	336	392	442	405	1,022	903	726	412	441	439
60%	314	344	312	279	399	311	716	756	418	389	420	431
70%	284	313	291	248	320	277	584	601	375	374	396	397
80%	248	270	270	229	232	226	469	541	347	349	374	370
90%	185	243	204	199	178	146	424	471	312	317	347	320
Long Term												
Full Simulation Period ^b	430	460	512	642	872	741	1,079	1,067	1,034	585	530	573
Water Year Types^c												
Wet (23%)	505	706	978	1,155	1,903	1,839	1,754	1,693	2,130	1,121	921	1,111
Above Normal (24%)	441	400	406	779	822	641	1,237	1,160	1,281	533	461	480
Below Normal (10%)	445	435	438	484	703	466	1,189	1,197	607	449	438	434
Dry (16%)	454	397	375	368	479	330	720	816	502	376	404	402
Critical (27%)	336	347	314	294	320	226	524	544	332	343	361	344

Revised Second Basis of Comparison 2												
Statistic	Monthly Flow (cfs)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	653	567	590	624	2,437	1,243	1,824	1,680	1,791	932	588	706
20%	577	482	480	506	987	615	1,626	1,588	1,545	564	488	506
30%	491	441	431	462	560	531	1,495	1,515	1,261	499	458	473
40%	424	409	382	434	498	458	1,303	1,285	1,041	443	445	446
50%	377	386	336	392	442	405	1,022	903	726	412	441	439
60%	314	344	312	279	399	311	716	756	418	389	420	431
70%	284	313	291	248	320	277	584	601	375	374	396	397
80%	248	270	270	229	232	226	469	541	347	349	374	370
90%	185	243	204	199	178	146	424	471	312	317	347	320
Long Term												
Full Simulation Period ^b	430	460	512	642	872	741	1,079	1,067	1,034	585	530	573
Water Year Types^c												
Wet (23%)	505	706	978	1,155	1,903	1,839	1,754	1,693	2,130	1,121	921	1,111
Above Normal (24%)	441	400	406	779	822	641	1,237	1,160	1,281	533	461	480
Below Normal (10%)	445	435	438	484	703	466	1,189	1,197	607	449	438	434
Dry (16%)	454	397	375	368	479	330	720	816	502	376	404	402
Critical (27%)	336	347	314	294	320	226	524	544	332	343	361	344

Revised Second Basis of Comparison 2 minus Revised Second Basis of Comparison												
Statistic	Monthly Flow (Percent Change)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Long Term												
Full Simulation Period ^b	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Water Year Types^c												
Wet (23%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Above Normal (24%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Below Normal (10%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Dry (16%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Critical (27%)	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in text.

Appendix 5E: Sensitivity Analysis - Revised Second Basis of Comparison with no Fremont Weir Notch

Table 5E.3.21. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP Deliveries

				Revised Second Basis of Comparison 2	Revised Second Basis of Comparison	Revised Second Basis of Comparison 2 minus Revised Second Basis of Comparison
Water Supply Reliability						
Sacramento River Hydrologic Region						
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term	1,858	1,858	0%
			Dry	1,905	1,905	0%
			Critical	1,734	1,732	0%
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	155	155	0%
			Dry	151	151	0%
			Critical	105	105	0%
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	214	214	0%
			Dry	192	192	0%
			Critical	151	151	0%
CVP Ag	Contract Delivery (annual average - does not include Settlement contractors)	(TAF/year)	Long Term	220	219	0%
			Dry	122	122	0%
			Critical	35	35	0%
San Joaquin River Hydrologic Region (not including Friant-Kern and Madera Canal water users and Eastside Contractors deliveries)						
CVP Exchange	Contract Delivery (annual average)	(TAF/year)	Long Term	852	852	0%
			Dry	875	875	0%
			Critical	741	741	0%
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	260	260	0%
			Dry	268	268	0%
			Critical	221	221	0%
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	17	17	0%
			Dry	15	15	0%
			Critical	12	12	0%
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	348	348	0%
			Dry	203	203	0%
			Critical	61	61	0%
San Francisco Bay Hydrologic Region						
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	286	286	0%
			Dry	292	292	0%
			Critical	305	305	0%
CVP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	43	43	0%
			Dry	25	25	-1%
			Critical	8	7	0%
Central Coast Hydrologic Region						
Tulare Lake Hydrologic Region (not including Friant-Kern Canal water users)						
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	12	12	0%
			Dry	12	12	0%
			Critical	10	10	0%
CVP Ag	Contract Delivery (annual average - includes Cross Valley Canal)	(TAF/year)	Long Term	709	709	0%
			Dry	424	422	0%
			Critical	127	127	0%
Total For All Regions						
Total Supplies	Contract Delivery (annual average)	(TAF/year)	Long Term	4,974	4,973	0%
			Dry	4,483	4,483	0%
			Critical	3,510	3,508	0%

Notes:

- 1) Long-term Average is the average quantity for the 82-year simulation period.
- 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
- 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.
- 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text.
- 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text.
- 6) Annual deliveries are based on March to February Average.
- 7) In the table on the following page, San Francisco Bay Hydrologic Region M&I deliveries are divided between North of Delta M&I deliveries (Contra Costa Water District) and South of Delta M&I deliveries (San Felipe Division); and San Francisco Bay Hydrologic Region Ag deliveries are only included in South of Delta Ag deliveries.

Appendix 5E: Sensitivity Analysis - Revised Second Basis of Comparison with no Fremont Weir Notch

Table 5E.3.22. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, CVP Deliveries

				Revised Second Basis of Comparison 2	Revised Second Basis of Comparison	Revised Second Basis of Comparison 2 minus Revised Second Basis of Comparison
Water Supply Reliability						
North of Delta						
CVP Ag	Contract Delivery (annual average; does not include Settlement contractors)	(TAF/year)	Long Term	220	219	0%
			Dry	122	122	0%
			Critical	35	35	0%
CVP M&I (Including American River)	Contract Delivery (annual average)	(TAF/year)	Long Term	392	392	0%
			Dry	390	390	0%
			Critical	383	383	0%
CVP M&I American River	Contract Delivery (annual average)	(TAF/year)	Long Term	120	120	0%
			Dry	105	105	0%
			Critical	79	79	0%
CVP Settlement	Contract Delivery (annual average)	(TAF/year)	Long Term	1,858	1,858	0%
			Dry	1,905	1,905	0%
			Critical	1,734	1,732	0%
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	155	155	0%
			Dry	151	151	0%
			Critical	105	105	0%
Total CVP North of Delta Ag and M&I Deliveries						
Total CVP Ag and M&I Deliveries	Contract Delivery (CVP) (annual average)	(TAF/year)	Long Term	612	612	0%
			Dry	512	512	0%
			Critical	418	418	0%
South of Delta (Not including Eastside Contractors deliveries, or Friant-Kern Canal or Madera Canal water users)						
CVP Ag	Contract Delivery (annual average; does not include Exchange contractors)	(TAF/year)	Long Term	1,100	1,100	0%
			Dry	652	650	0%
			Critical	195	195	0%
CVP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	124	125	0%
			Dry	109	109	-1%
			Critical	85	85	0%
CVP Exchange	Contract Delivery (annual average)	(TAF/year)	Long Term	852	852	0%
			Dry	875	875	0%
			Critical	741	741	0%
CVP Refuge Level 2	Contract Delivery (annual average)	(TAF/year)	Long Term	272	272	0%
			Dry	280	280	0%
			Critical	232	232	0%
Total CVP South of Delta Ag and M&I Deliveries						
Total CVP Ag and M&I Deliveries	Contract Delivery (annual average)	(TAF/year)	Long Term	1,225	1,225	0%
			Dry	760	759	0%
			Critical	280	280	0%
Eastside Contractors deliveries						
Water Rights	Delivery (annual average)	(TAF/year)	Long Term	514	514	0%
			Dry	524	524	0%
			Critical	486	486	0%
CVP Service Contracts	Contract Delivery (annual average)	(TAF/year)	Long Term	118	118	0%
			Dry	98	98	0%
			Critical	25	25	0%
Total Eastside Contractors Deliveries						
Total Water Rights and CVP Service Contracts Deliveries	Delivery (annual average)	(TAF/year)	Long Term	632	632	0%
			Dry	621	621	0%
			Critical	511	511	0%

Notes:

- 1) Long-term Average is the average quantity for the 82-year simulation period.
- 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
- 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.
- 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text.
- 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text.
- 6) Annual deliveries are based on March to February Average.

Appendix 5E: Sensitivity Analysis - Revised Second Basis of Comparison with no Fremont Weir Notch

Table 5E.3.23. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, SWP Deliveries

				Revised Second Basis of Comparison 2	Revised Second Basis of Comparison	Revised Second Basis of Comparison 2 minus Revised Second Basis of Comparison
Water Supply Reliability						
Sacramento River Hydrologic Region						
SWP FRSA	Contract Delivery (annual average)	(TAF/year)	Long Term	930	931	0%
			Dry	946	946	0%
			Critical	707	709	0%
SWP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	27	26	0%
			Dry	19	19	0%
			Critical	12	12	0%
San Joaquin River Hydrologic Region						
SWP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	4	4	0%
			Dry	3	3	0%
			Critical	2	2	0%
San Francisco Bay Hydrologic Region						
SWP M&I (w/o Article 21)	Contract Delivery (includes transfers to SWP contractors) (annual average)	(TAF/year)	Long Term	220	219	0%
			Dry	167	166	0%
			Critical	103	103	0%
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	21	22	-1%
			Dry	20	20	-1%
			Critical	12	12	-1%
Central Coast Hydrologic Region						
SWP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	52	52	0%
			Dry	39	39	0%
			Critical	24	24	3%
Tulare Lake Hydrologic Region						
SWP M&I	Contract Delivery (annual average)	(TAF/year)	Long Term	99	99	0%
			Dry	75	75	0%
			Critical	45	45	0%
SWP Ag (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	737	735	0%
			Dry	555	554	0%
			Critical	339	337	1%
SWP Ag Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	174	174	0%
			Dry	142	143	0%
			Critical	29	29	0%
South Lahontan Hydrologic Region						
SWP M&I (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	325	325	0%
			Dry	253	252	0%
			Critical	157	156	1%
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	4	4	0%
			Dry	4	4	0%
			Critical	2	2	0%
South Coast Hydrologic Region						
SWP M&I (w/o Article 21)	Contract Delivery (includes transfers to SWP contractors) (annual average)	(TAF/year)	Long Term	1,539	1,540	0%
			Dry	1,236	1,235	0%
			Critical	779	783	-1%
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	89	89	0%
			Dry	74	74	-1%
			Critical	9	9	-1%
SWP Ag (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	9	9	1%
			Dry	7	7	0%
			Critical	4	4	4%
SWP Ag Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	2	2	1%
			Dry	1	1	4%
			Critical	1	1	0%
Total For All Regions						
Total Supplies (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	3,942	3,941	0%
			Dry	3,300	3,296	0%
			Critical	2,172	2,174	0%
Total Article 21 Supplies	Contract Delivery (annual average)	(TAF/year)	Long Term	290	291	0%
			Dry	241	243	-1%
			Critical	52	52	-1%

Notes:

- 1) Long-term Average is the average quantity for the 82-year simulation period.
- 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
- 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.
- 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text.
- 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Appendix 5E: Sensitivity Analysis - Revised Second Basis of Comparison with no Fremont Weir Notch

Table 5E.3.24. CALSIM II Summary Reporting Metrics, Long-Term Average and Dry and Critical Year Averages, SWP Deliveries

				Revised Second Basis of Comparison 2	Revised Second Basis of Comparison	Revised Second Basis of Comparison 2 minus Revised Second Basis of Comparison
Water Supply Reliability						
North of Delta						
SWP Ag	Contract Delivery (annual average)	(TAF/year)	Long Term	0	0	0%
			Dry	0	0	0%
			Critical	0	0	0%
SWP M&I (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	83	83	0%
			Dry	62	62	0%
			Critical	53	53	0%
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	12	12	-1%
			Dry	13	13	-1%
			Critical	12	12	-1%
Total SWP North of Delta						
Total SWP Ag and M&I NOD (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	83	83	0%
			Dry	62	62	0%
			Critical	53	53	0%
Total SWP Ag and M&I Article 21 NOD	Contract Delivery (annual average)	(TAF/year)	Long Term	12	12	-1%
			Dry	13	13	-1%
			Critical	12	12	-1%
South of Delta						
SWP Ag (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	750	749	0%
			Dry	566	564	0%
			Critical	483	481	0%
SWP Ag Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	176	176	0%
			Dry	143	144	0%
			Critical	100	101	0%
SWP M&I (w/o Article 21)	Contract Delivery (includes transfers to SWP contractors) (annual average)	(TAF/year)	Long Term	2,178	2,179	0%
			Dry	1,727	1,725	0%
			Critical	1,485	1,484	0%
SWP M&I Article 21	Contract Delivery (annual average)	(TAF/year)	Long Term	102	103	0%
			Dry	85	86	-1%
			Critical	58	59	-1%
Total SWP South of Delta						
Total SWP Ag and M&I SOD (w/o Article 21)	Contract Delivery (annual average)	(TAF/year)	Long Term	2,929	2,928	0%
			Dry	2,292	2,289	0%
			Critical	1,968	1,965	0%
Total SWP Ag and M&I Article 21 SOD	Contract Delivery (annual average)	(TAF/year)	Long Term	278	279	0%
			Dry	228	230	-1%
			Critical	159	159	-1%

Notes:

- 1) Long-term Average is the average quantity for the 82-year simulation period.
- 2) Dry and Critical Year designations are defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
- 3) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions.
- 4) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences are discussed in the text.
- 5) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences are discussed in the text.

Appendix 6A was not used in this document.

This page left blank intentionally.

1 **Appendix 6B, Section A**

2 **Surface Water Temperature Modeling**

3 This appendix provides information about the methods and assumptions used for
 4 the Coordinated Long-Term Operation of the Central Valley Project (CVP) and
 5 State Water Project (SWP) Environmental Impact Statement (EIS) analysis on
 6 surface water temperature. The appendix also provides temperature model results
 7 and interpretation methods used for the impacts analysis and descriptions.
 8 Additional information pertaining to the development of the analytical tools,
 9 incorporating climate change, and the use of input data from other models, is also
 10 provided. This appendix is organized into three sections that are briefly described
 11 below:

- 12 • Appendix 6B, Section A: Surface Water Temperature Modeling Methodology,
 13 Simulations, and Assumptions
 - 14 – The water quality impacts analysis uses the HEC-5Q and Reclamation
 15 Monthly Temperature models to assess and quantify effects of the
 16 alternatives on the environment. This section provides information about
 17 the overall analytical framework linkages with other models.
 - 18 – This section provides a brief description of the assumptions for the surface
 19 water temperature model simulations of the No Action Alternative,
 20 Second Basis of Comparison, and other alternatives.
- 21 • Appendix 6B, Section B: Surface Water Temperature Modeling Results
 - 22 – This section provides model outputs and a description of the model
 23 simulation output formats used in the analysis and interpretation of
 24 modeling results for the alternatives impacts assessment.
- 25 • Appendix 6B, Section C: HEC-5Q Model Update for Surface Water
 26 Temperature Modeling
 - 27 – This section provides a detailed description of the compilation and updates
 28 of the HEC-5Q models performed during development of the EIS for the
 29 Trinity-Sacramento, American, and Stanislaus Rivers.

30 **6B.A.1 Surface Water Temperature Modeling**
 31 **Methodology**

32 This section summarizes the surface water temperature modeling methodology
 33 used for the No Action Alternative, Second Basis of Comparison, and other
 34 alternatives. It describes how temperature modeling fits into the overall analytical
 35 framework and contains descriptions of the key analytical and numerical tools and
 36 approaches used in the quantitative evaluation of the alternatives.

37 In the evaluation of the No Action Alternative, Second Basis of Comparison, and
 38 other alternatives, climate change assumptions at the Year 2030 are used to

1 develop modified climate input files for the temperature models. The modeling
2 assumptions are provided in Section 6B.A.2.

3 **6B.A.1.1 Overview of the Modeling Approach**

4 To support the water quality and aquatic resources impact analyses of the
5 alternatives, modeling of surface water temperature in the Central Valley is
6 necessary to evaluate changes to conditions affecting surface water temperatures
7 in rivers that are affected by SWP and CVP operations. Two different surface
8 water temperature modeling tools were used for the analysis. The HEC-5Q model
9 simulated daily temperatures for the Trinity River (downstream of Lewiston
10 Dam), Sacramento River (from Keswick Dam to the Feather River confluence),
11 American River (from Nimbus Dam to Sacramento River confluence), and
12 Stanislaus River (from New Melones Dam to the confluence with San Joaquin
13 River). The Reclamation Temperature Model was used for simulating monthly
14 temperatures for the Feather and Lower Sacramento (from the Feather River
15 confluence to Freeport) rivers. Both models used CalSim II outputs as stream
16 flow and reservoir storage inputs. The results from these models are used to
17 inform the understanding of effects on the surface water temperature of each
18 individual alternative considered in the EIS.

19 **6B.A.1.1.1 HEC-5Q**

20 Over the past 15 years, various temperature models were developed to simulate
21 temperature conditions on the rivers affected by CVP and SWP operations
22 (Sacramento River Water Quality Model [SRWQM], San Joaquin River HEC-5Q
23 model) (Reclamation 2008). Recently, these models were compiled and updated
24 into a single modeling package hereafter referred to as the HEC-5Q model.
25 Further updates were performed under the EIS modeling that included improved
26 meteorological data and subsequent validation of the Sacramento and American
27 River models, implementation of the Folsom Temperature Control Devices and
28 low-level outlet, implementation of the Trinity River auxiliary outlet, improved
29 temperature targeting for the Shasta and Folsom Dams, as well as improved
30 documentation and streamlining of the models as well as improved integration
31 with the CalSim II model.

32 Section 6B.C.4 of this appendix is consistent with the technical memorandum
33 submitted to Reclamation that documented changes in the HEC-5Q compilation
34 and updates for the temperature models.

35 The HEC-5Q model contains three separate models that simulate reservoir and
36 river temperatures:

- 37 • The Trinity River from Trinity Dam to below Lewiston Dam and the
38 Sacramento River from Shasta Dam to the Feather River confluence.
39 Reservoir temperatures are simulated for Trinity Lake, Lewiston Reservoir,
40 Shasta Lake, Keswick Reservoir, and Black Butte Reservoir (see
41 Figure 6B.A.1 for a schematic of the Trinity-Sacramento River HEC-5Q
42 model).

- 1 • The American River from Folsom Dam to the confluence with the Sacramento
2 River. Reservoir temperatures were simulated for Folsom Lake and Lake
3 Natoma (see Figure 6B.A.2 for a schematic of the American River HEC-5Q
4 model).
- 5 • The Stanislaus River from upstream of New Melones Reservoir to the
6 confluence with the San Joaquin River and the lower San Joaquin River from
7 the Stanislaus River confluence to below Vernalis. Reservoir temperatures
8 were simulated for New Melones Reservoir (see Figure 6B.A.3 for a
9 schematic of the Stanislaus River HEC-5Q model).

10 The HEC-5Q model was developed using integrated HEC-5 and HEC-5Q models.
11 The HEC-5 component of the model simulates daily reservoir and river flow
12 operations from monthly CalSim II data that are disaggregated to daily data. The
13 HEC-5Q component simulates mean daily reservoir and river temperatures based
14 on the daily flow inputs and meteorological parameters specified on a 6-hour time
15 step.

16 **6B.A.1.1.2 Reclamation Temperature Model**

17 The Reclamation Temperature Model includes reservoir and stream temperature
18 models that simulate monthly reservoir and stream temperatures used for
19 evaluating the effects of CVP and SWP project operations on mean monthly water
20 temperatures in the basin (Reclamation 2008). The model simulates temperatures
21 in seven major reservoirs (Trinity Lake, Whiskeytown Reservoir, Shasta Lake,
22 Oroville Reservoir, Folsom Lake, New Melones Reservoir, and Tulloch
23 Reservoir), four downstream regulating reservoirs (Lewiston, Keswick, and
24 Goodwin reservoirs; Lake Natoma), and five main river systems (Trinity,
25 Sacramento, Feather, American, and Stanislaus rivers). The river component of
26 the Reclamation Temperature Model calculates temperature changes in the
27 regulating reservoirs, below the main reservoirs. With regulating reservoir release
28 temperature as the initial river temperature, the river model computes
29 temperatures at several locations along the rivers. The calculation points for river
30 temperatures generally coincide with tributary inflow locations. The model is
31 one-dimensional in the longitudinal direction and assumes fully mixed river cross
32 sections. The effect of tributary inflow on river temperature is computed by mass
33 balance calculation. The river temperature calculations are based on regulating
34 reservoir release temperatures, river flows, and climatic data.

35 For the EIS, the Reclamation Temperature Model was used for the Feather River
36 and lower Sacramento River from the Feather River confluence to Freeport.
37 Sacramento, Trinity, American, and Stanislaus rivers temperature effects were
38 analyzed using the daily HEC-5Q models described in the previous section.

39 For more information on the Reclamation Temperature Model, see Appendix H of
40 the Reclamation's 2008 Operation Criteria and Plan (OCAP) Biological
41 Assessment (BA) (Reclamation 2008).

1 **6B.A.2 Surface Water Temperature Modeling**
2 **Simulations and Assumptions**

3 This section describes the assumptions for the HEC-5Q and Reclamation
4 Temperature Model monthly temperature simulations of the No Action
5 Alternative, Second Basis of Comparison, and Alternatives 1 through 5.

6 The following model simulations were performed as the basis of evaluating the
7 impacts of Alternatives 1 through 5 as compared to the No Action Alternative,
8 and the No Action Alternative and Alternatives 1 through 5 as compared to the
9 Second Basis of Comparison:

- 10 • No Action Alternative
- 11 • Second Basis of Comparison
- 12 • Alternative 1 – for simulation purposes, considered the same as Second Basis
13 of Comparison
- 14 • Alternative 2 – for simulation purposes, considered the same as No Action
15 Alternative
- 16 • Alternative 3
- 17 • Alternative 4 – for simulation purposes, considered the same as Second Basis
18 of Comparison.
- 19 • Alternative 5

20 Assumptions for each of these alternatives were developed with the surface water
21 modeling tools and are described in Appendix 5A, Section B.

22 Alternative 1 modeling assumptions are the same as the Second Basis of
23 Comparison and Alternative 2 modeling assumptions are the same as the No
24 Action Alternative; therefore, the assumptions for those alternatives are not
25 discussed separately in this document.

26 The general modeling assumptions described below pertain to the model runs for
27 the No Action Alternative, Second Basis of Comparison, and Alternatives 1
28 through 5.

29 **6B.A.2.1 Input Storage and Streamflow**

30 **6B.A.2.1.1 HEC-5Q**

31 Monthly flows simulated by the CalSim II model for an 82-year period (water
32 years 1922 through 2003) are used as input to HEC-5Q. Temporal downscaling is
33 performed¹ on the CalSim II monthly average tributary flows to convert them to

¹ A constant daily flow that is equivalent to monthly average flow simulated in CalSim II is assumed throughout the month for each month of the 82-year CalSim II simulation period. An exception to this is the inflow timeseries to Trinity, Shasta, and New Melones reservoirs, where monthly average inflows are downscaled to a daily timestep by fitting to a cubic-spline. This allows simulation of a daily varying inflow into the reservoirs with a smooth transition between the individual months, while assuming the same monthly volume of inflow consistent with CalSim II.

- 1 daily average flows for HEC-5Q input using a pre-processing tool (see
- 2 Tables 6B.A.1 to 6B.A.3 for a list of all of the CalSim II inputs).

3 **Table 6B.A.1 CalSim II Input Mapping with Trinity-Sacramento River HEC-5Q Model**

HEC-5Q Control Point Number	HEC-5Q Control Point Name	Input Types	CalSim II Node
340	Trinity Reservoir	Storage Inflow Outflow Evaporation	S1 I1 C1+F1 E1
330	Lewiston Reservoir	Inflow Diversion	I100 D100
240	Whiskeytown Reservoir	Storage Inflow Outflow Evaporation	S3 I3 C3+F3 E3
220	Shasta Reservoir	Storage Inflow Outflow Evaporation	S4 I4 C4+F4 E4
200	Keswick Reservoir	Evaporation	E5
180	Sacramento River below Clear Creek Confluence	Diversion	C5-C104
178	Sacramento River below Cow Creek Confluence	Inflow	C10801
176	Sacramento River below Cottonwood Creek Confluence	Inflow	C10802
172	Sacramento River below Battle Creek Confluence	Inflow	C10803
170	Sacramento River at Bend Bridge	Inflow Diversion	I109+R109 D109
160	Sacramento River above Red Bluff Diversion Dam	Inflow Diversion	C11001+I112 D112
150	Sacramento River below Woodson Bridge	Inflow Diversion	C11305+C11301+R113+R114A+R114B+R114C D113A+D113B
140	Sacramento River at GCID	Diversion	D114
1136	Black Butte Reservoir	Storage Inflow Outflow Diversion	S42 I42+C41 C42+F42 E42+D42

Appendix 6B.A: Surface Water Temperature Modeling

HEC-5Q Control Point Number	HEC-5Q Control Point Name	Input Types	CalSim II Node
1134	Stony Creek Diversions	Diversion	C42-C142A
1132	Stony Creek Confluence	Inflow	C11501
132	Sacramento River at Ord Ferry	Diversion	D117
130	Sacramento River at Butte City	Inflow Diversion	I118 I118+C115-C118-D117
128	Sacramento River above Moulton Weir	Inflow Diversion	I123+c17603 C118+I123+C17603-C124
126	Sacramento River at Moulton Weir	Diversion	D124
120	Sacramento River at Colusa Weir	Diversion	D125
116	Sacramento River at Tisdale Weir	Diversion	D126
114	Sacramento River above Knights Landing	Diversion	C126-C129
112	Sacramento River at Knights Landing	Diversion	C129-C134
365	Butte Creek BP3	Diversion	C136B-R137-R135A-R135B-C217A

1 **Table 6B.A.2 CalSim II Input Mapping with American River HEC-5Q Model**

HEC-5Q Control Point Number	HEC-5Q Control Point Name	Input Types	CalSim II Node
590	Folsom Reservoir	Storage Inflow Outflow Diversion	S8 C300+I8 C8+F8 E8+D8
580	Natoma Reservoir	Storage Diversion	S9 D9+E9-I9
572	American River above City of Sacramento Diversion	Diversion	GS66-I302
570	American River at City of Sacramento Diversion	Diversion	D302

1 **Table 6B.A.3 CalSim II Input Mapping with Stanislaus River HEC-5Q Model**

HEC-5Q Control Point Number	HEC-5Q Control Point Name	Input Types	CalSim II Node
240	New Melones Reservoir	Storage Inflow Outflow Evaporation	S10 I10 C10+F10 E10
220	Tulloch Reservoir	Storage Inflow Diversion	S76 I76 E76
200	Goodwin Reservoir	Inflow Diversion	I520 C76-C520
160	Stanislaus River at Knights Ferry	Diversion	C520-C528
150	Stanislaus River at Orange Blossom Bridge	Diversion	C520-C528
140	Stanislaus River at Oakdale Highway 120 Bridge	Diversion	C520-C528
130	Stanislaus River at Riverbank Bridge	Diversion	C520-C528
120	Stanislaus River at McHenry Bridge	Diversion	C520-C528
110	Stanislaus River at Ripon Gage	Diversion	C520-C528
400	San Joaquin River above Stanislaus River Confluence Dummy Reservoir	Diversion	C620+C545+C528-C644
98	San Joaquin River at Vernalis	Diversion	C620+C545+C528-C644

2 **6B.A.2.1.2 Reclamation Temperature Model**

3 Monthly flows that were simulated by the CalSim II model for an 81-year period
 4 (January 1922 to December 2002) are used as input to the model. Because of the
 5 CalSim II model’s complex structure, where applicable, flow arcs were combined
 6 at the appropriate temperature nodes to ensure compatibility with the Reclamation
 7 Temperature Model.

8 **6B.A.2.2 Climate Change Assumptions**

9 When simulating alternatives with climate change, some of the inputs to the
 10 temperature models must be modified. This section presents the assumptions and
 11 approaches used for modifying meteorological and inflow temperatures in the

1 temperature models. For the alternative simulations, climate assumptions were
2 established around Year 2030. Therefore, to be consistent with the other water
3 supply and economics models, the climate input data for HEC-5Q and
4 Reclamation Temperature Model were modified to represent approximate
5 conditions at Year 2030.

6 **6B.A.2.2.1 HEC-5Q**

7 HEC-5Q requires meteorological inputs specified in the form of equilibrium
8 temperatures, exchange rates, shortwave radiation and wind speed. The exchange
9 rates and equilibrium temperatures are computed from hourly observed data at the
10 Gerber gauging station. Considering the uncertainties associated with climate
11 change impacts, it was assumed that the equilibrium temperature inputs derived
12 from observed data would be modified by the change in daily average air
13 temperature projected under the climate change scenarios.

14 The inflow temperatures in HEC-5Q are specified as seasonal curve fit values
15 with diurnal variations superimposed as a function of heat exchange parameters.
16 The seasonal temperature values are derived based on the observed flows and
17 temperatures for each inflow. HEC-5Q superimposes diurnal variations on the
18 seasonal values specified using the heat exchange parameter inputs. The diurnal
19 variations are superimposed by adjusting the equilibrium temperature to reflect
20 the inflow location environment and scaling it based on the heat exchange rate
21 scaling factor and the weighting factor for emphasis on the seasonal values
22 specified. In this fashion, any climate change effects accounted for in the
23 equilibrium temperature are translated to the changes in inflow temperatures in
24 the HEC-5Q. Therefore, for the climate change scenarios, only the equilibrium
25 temperatures were adjusted for the projected change in temperature, and these
26 influence the inflow temperatures; however, independent inflow temperature
27 inputs were not changed.

28 **6B.A.2.2.2 Reclamation Temperature Model**


29 The Reclamation Temperature Model requires mean monthly meteorological
30 inputs of air and equilibrium temperature and heat exchange rates. The heat
31 exchange rates and equilibrium temperatures are computed from the mean
32 monthly air temperature data and long-term estimates of solar radiation, relative
33 humidity, wind speed, cloud cover, solar reflectivity, and river shading.
34 Considering the uncertainties associated with climate change impacts, it was
35 assumed that the equilibrium temperature and heat exchange rate inputs would be
36 modified by the change in mean monthly air temperature in the climate change
37 scenarios.

38 Reservoir inflow temperatures were derived from the available record of observed
39 data and averaged by month. The mean monthly inflow temperatures are then
40 repeated for each study year. For alternatives modeled with climate change, the
41 inflow temperatures were modified based on the projected long-term average
42 change in mean annual air temperature for each month.

1 **6B.A.3 Reference**


- 2 Reclamation (Bureau of Reclamation). 2008. *2008 Central Valley Project and*
3 *State Water Project Operations Criteria and Plan Biological Assessment,*
4 *Appendix H Reclamation Temperature Model and SRWQM Temperature*
5 *Model.*

Appendix 6B.A: Surface Water Temperature Modeling

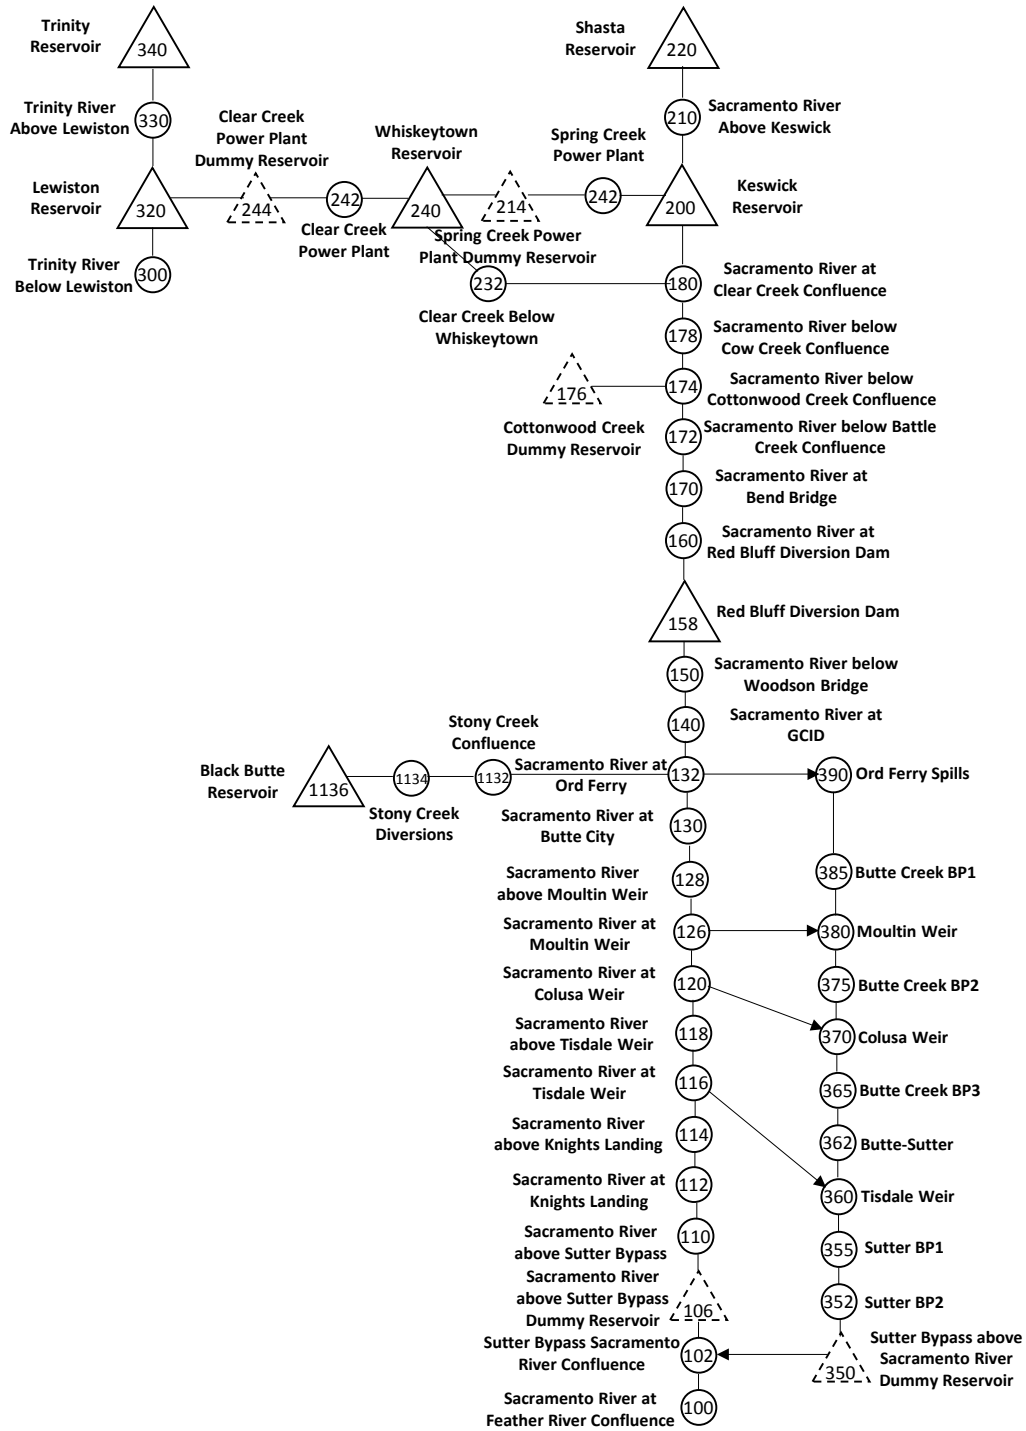

1


2 **Figure 6B.A.1 Schematic of Trinity-Sacramento River HEC-5Q Model**

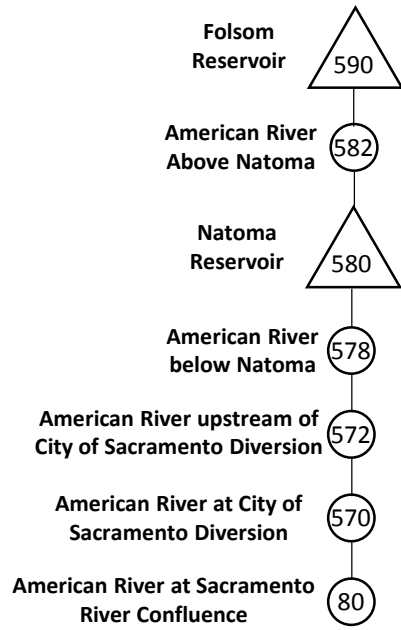

1

2 **Figure 6B.A.2 Schematic of American River HEC-5Q Model**

Appendix 6B.A: Surface Water Temperature Modeling

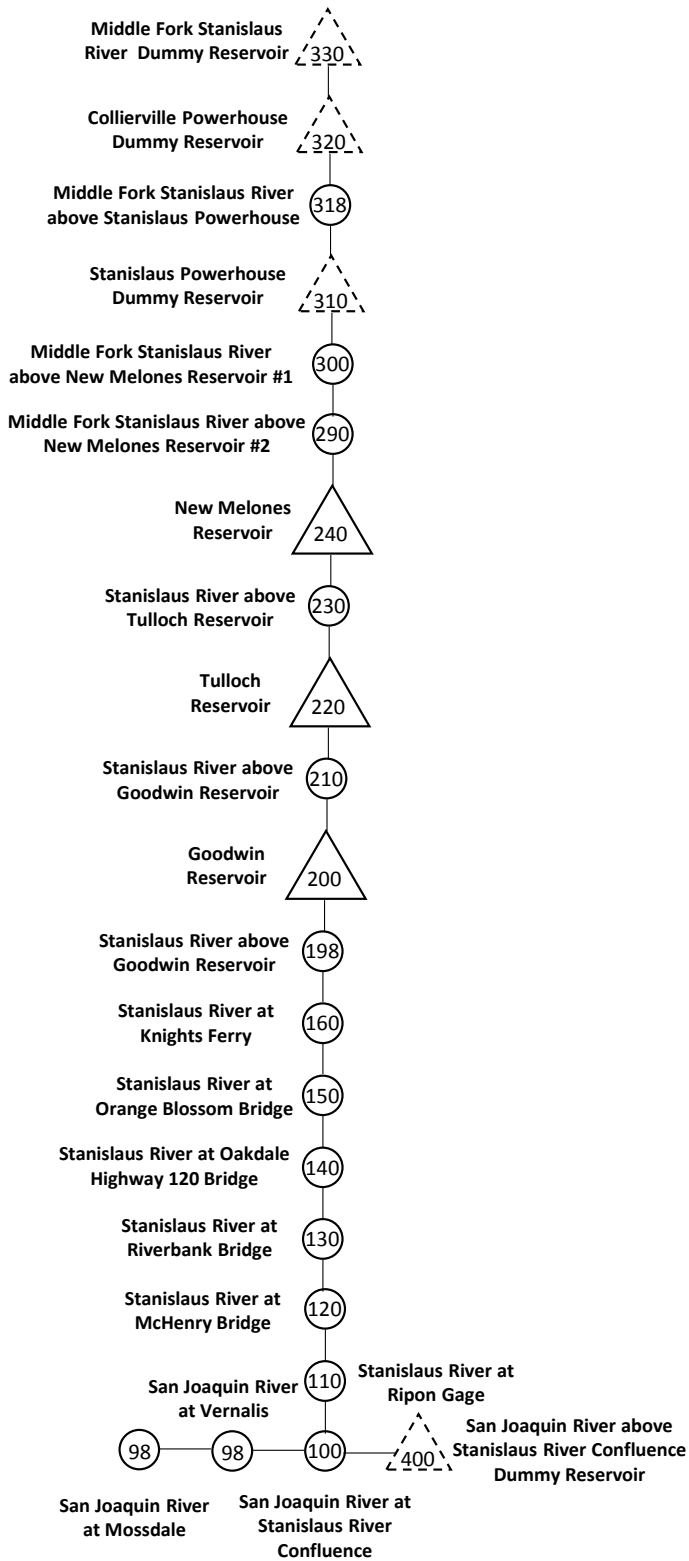

1

2 **Figure 6B.A.3 Schematic of Stanislaus River HEC-5Q Model**

1 **Appendix 6B, Section B**

2 **Surface Water Temperature Modeling**
3 **Results**

4 This appendix provides information about the methods and assumptions used for
5 the Coordinated Long-Term Operation of the Central Valley Project (CVP) and
6 State Water Project (SWP) Environmental Impact Statement (EIS) analysis on
7 surface water temperature. The appendix is organized into three sections that are
8 briefly described below:

- 9 • Appendix 6B, Section A: Surface Water Temperature Modeling Methodology,
10 Simulations, and Assumptions
 - 11 – The water quality impacts analysis uses the HEC-5Q and Reclamation
12 Monthly Temperature models to assess and quantify effects of the
13 alternatives on the environment. This section provides information about
14 the overall analytical framework linkages with other models.
 - 15 – This section provides a brief description of the assumptions for the surface
16 water temperature model simulations of the No Action Alternative,
17 Second Basis of Comparison, and other alternatives.
- 18 • Appendix 6B, Section B: Surface Water Temperature Modeling Results
 - 19 – This section provides model outputs and a description of the model
20 simulation output formats used in the analysis and interpretation of
21 modeling results for the alternatives impact assessment.
- 22 • Appendix 6B, Section C: HEC-5Q Model Update for Surface Water
23 Temperature Modeling
 - 24 – This section provides a detailed description of the compilation and updates
25 of the HEC-5Q models performed during development of the EIS for the
26 Trinity-Sacramento, American, and Stanislaus Rivers.

27 **6B.B.1 Introduction**

28 This section provides surface water temperature model (HEC-5Q and
29 Reclamation Temperature Model) simulation results for alternatives evaluated for
30 the EIS. The sections provided for each parameter include figures and tables in
31 various formats to provide the reader with tools for multiple ways of analysis.

32 The different types of presentations are explained as follows:

- 33 • **Probability of Exceedance Plots:** Probability of exceedance plots provide the
34 frequency of occurrence of values of a parameter that exceed a reference
35 value. For this appendix, the calculation of exceedance probability is done by
36 ranking the data. For example, for Shasta storage end-of-September
37 exceedance plot, Shasta storage values at the end of September for each

1 simulated year are sorted in ascending order. The smallest value would have a
2 probability of exceedance of 100 percent since all other values would be
3 greater than that value; and the largest value would have a probability of
4 exceedance of 0 percent. All of the values are plotted with probability of
5 exceedance on the x-axis and the value of the parameter on the y-axis.
6 Following the same example, if for one scenario, Shasta Lake end-of-
7 September storage of 2,000 thousand acre-feet (TAF) corresponds to
8 80 percent probability, it implies that Shasta end-of-September storage is
9 higher than 2,000 TAF in 80 percent of the years under the simulated
10 conditions.

11 • **Long-Term Average Summary and Year-Type-Based Statistics Summary**
12 **Tables:** These tables provide parameter values for each 10 o increment of
13 exceedance probability (rows) for each month (columns) as well as long-term
14 and year-type averages (using the Sacramento Valley 40-30-30 Index
15 developed by the State Water Resources Control Board for projected climate
16 at Year 2030) for each month. For a few parameters, such as Delta outflow,
17 annual total or average values are added to the tables (for volume and rates,
18 respectively).

19 All plots and tables are prepared to accommodate following comparisons:

- 20 • No Action Alternative (with climate change and sea-level rise at Year 2030)
21 compared to the Second Basis of Comparison (with climate change and
22 sea-level rise at Year 2030)
- 23 • Alternatives (with climate change and sea-level rise at Year 2030) compared
24 to the No Action Alternative
- 25 • Alternatives (with climate change and sea-level rise at Year 2030) compared
26 to the Second Basis of Comparison

27 **6B.B.1.1 Appropriate Use of Model Results**

28 The physical models developed and applied in the EIS analysis are generalized
29 and simplified representations of a complex water resources system. A brief
30 description of the appropriate use of the model results to compare two scenarios
31 or to compare against threshold values or standards is presented below.

32 **6B.B.1.1.1 Absolute vs. Relative Use of the Model Results**

33 The models are not predictive models (in how they are applied in this project),
34 and therefore the results cannot be considered as absolute with and within a
35 quantifiable confidence interval. The model results are only useful in a
36 comparative analysis and can only serve as an indicator of condition (e.g.,
37 compliance with a standard) and of trend (e.g., generalized impacts).

38 **6B.B.1.2 Appropriate Reporting Time-Step**

39 Due to the assumptions involved in the input data sets and model logic, care must
40 be taken to select the most appropriate time-step for the reporting of model
41 results. Sub-monthly (e.g., weekly or daily) reporting of model results is

1 inappropriate for all models and the results should be presented on a monthly
2 basis.

3 **6B.B.1.3 Statistical Comparisons Are Preferred**

4 Absolute differences computed at a point in time between model results from an
5 alternative and a baseline to evaluate impacts is an inappropriate use of model
6 results (e.g., computing differences between the results from a baseline and an
7 alternative for a particular day or month and year within the period of record of
8 simulation). Likewise computing absolute differences between an alternative
9 (or a baseline) and a specific threshold value or standard is an inappropriate use of
10 model results. Statistics computed based on the absolute differences at a point in
11 time (e.g., average of monthly differences) are an inappropriate use of model
12 results. By computing the absolute differences in this way, disregards the changes
13 in antecedent conditions between individual scenarios and distorts the evaluation
14 of impacts of a specific action.

15 Reporting seasonal patterns from long-term averages and water year-type
16 averages is appropriate. Statistics computed based on long-term and water
17 year-type averages are an appropriate use of model results. Computing
18 differences between long-term or water year type averages of model results from
19 two scenarios are appropriate. Care should be taken to use the appropriate water
20 year type for presenting water year-type average statistics of model results
21 (e.g., D1641 Sacramento River 40-30-30 index or San Joaquin River 60-20-20
22 index based on climate modifications). For this study, water year-types are based
23 on the projected climate and hydrology at Year 2030.

24 The most appropriate presentation of monthly and annual model results is in the
25 form of probability distributions and comparisons of probability distributions
26 (e.g., cumulative probabilities). If necessary, comparisons of model results
27 against threshold or standard values should be limited to comparisons based on
28 cumulative probability distributions.

29 **6B.B.2 Results**

30 The results are presented in the following figures.


- 31 • B.1. Trinity River below Lewiston Temperature
- 32 • B.2. Clear Creek below Whiskeytown Temperature
- 33 • B.3. Clear Creek at Igo Temperature
- 34 • B.4. Clear Creek at Mouth Temperature
- 35 • B.5. Sacramento River below Keswick Temperature
- 36 • B.6. Sacramento River at Balls Ferry Temperature
- 37 • B.7. Sacramento River at Jellys Ferry Temperature
- 38 • B.8. Sacramento River at Bend Bridge Temperature
- 39 • B.9. Sacramento River at Red Bluff Temperature
- 40 • B.10. Sacramento River at Hamilton City Temperature
- 41 • B.11. Sacramento River at Knights Landing Temperature

Appendix 6B.B: Surface Water Temperature Modeling Results

- 1 • B.12. American River below Nimbus Temperature
- 2 • B.13. American River at Watt Avenue Temperature
- 3 • B.14. American River at Mouth Temperature
- 4 • B.15. Stanislaus River below New Melones Temperature
- 5 • B.16. Stanislaus River below Tulloch Temperature
- 6 • B.17. Stanislaus River below Goodwin Temperature
- 7 • B.18. Stanislaus River at Orange Blossom Bridge Temperature
- 8 • B.19. Stanislaus River at Mouth Temperature
- 9 • B.20. Feather River Low Flow Channel
- 10 • B.21. Feather River at Robinson Riffle
- 11 • B.22. Feather River at Gridley Bridge
- 12 • B.23. Feather River at Mouth


B.1. Trinity River below Lewiston Temperature

Figure B-1-1. Trinity River below Lewiston Dam, October

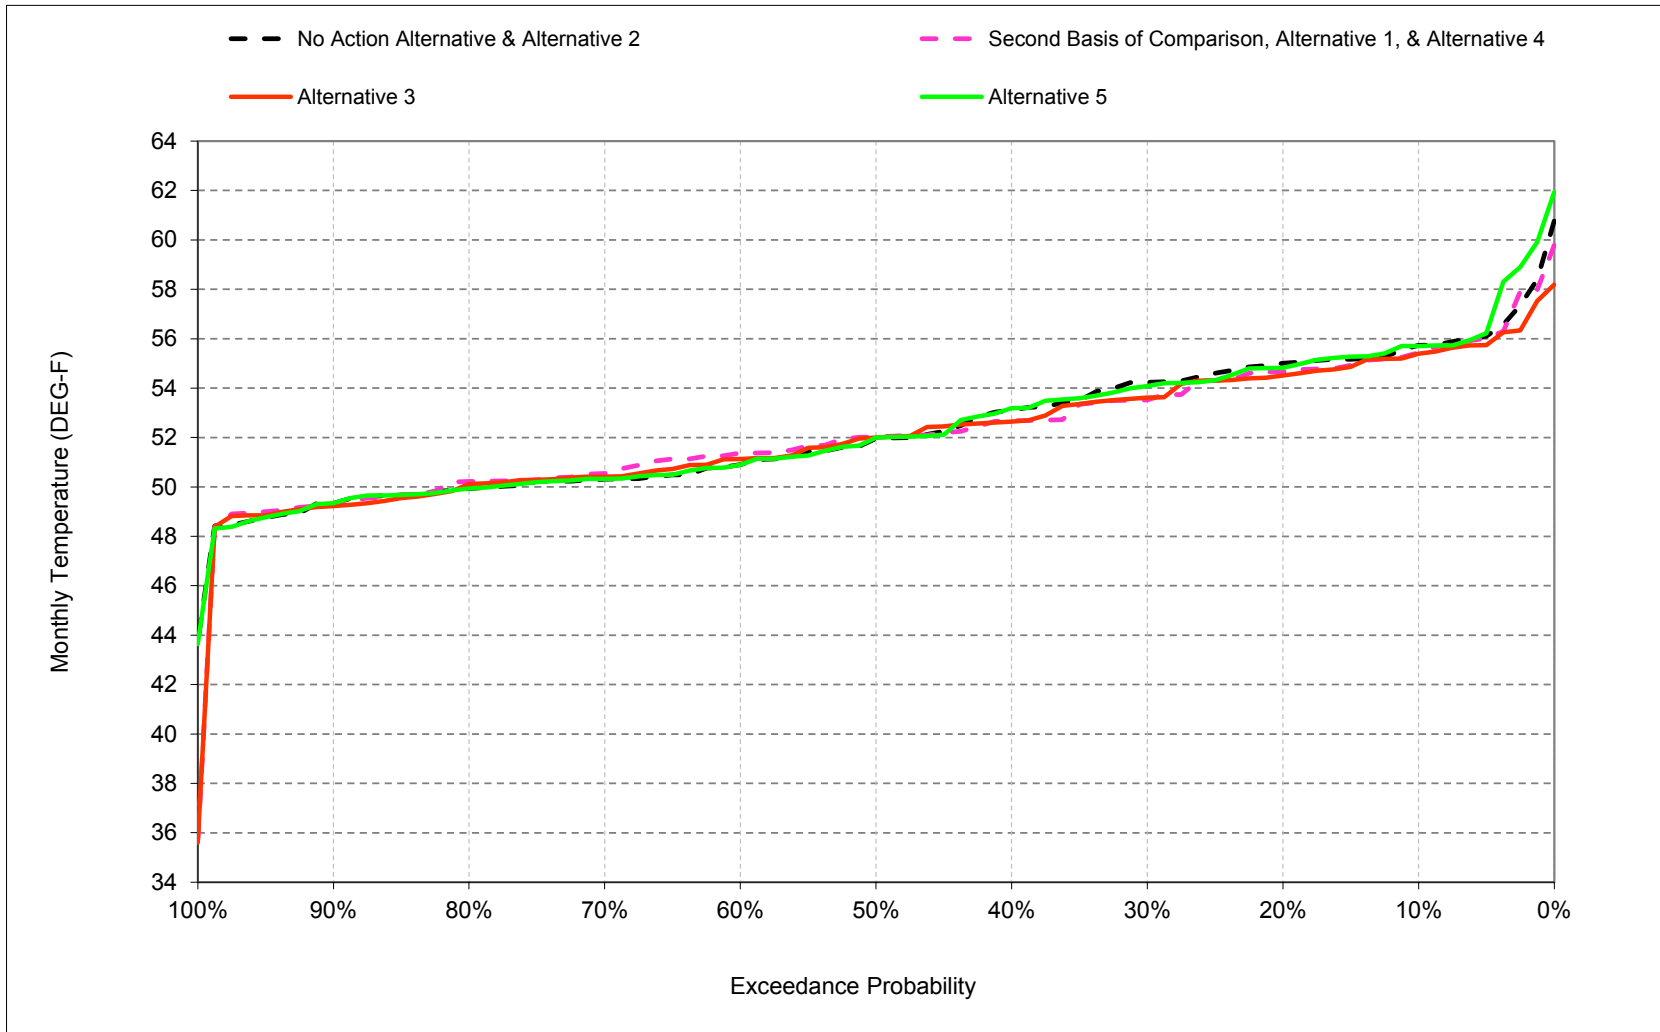


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-1-2. Trinity River below Lewiston Dam, November

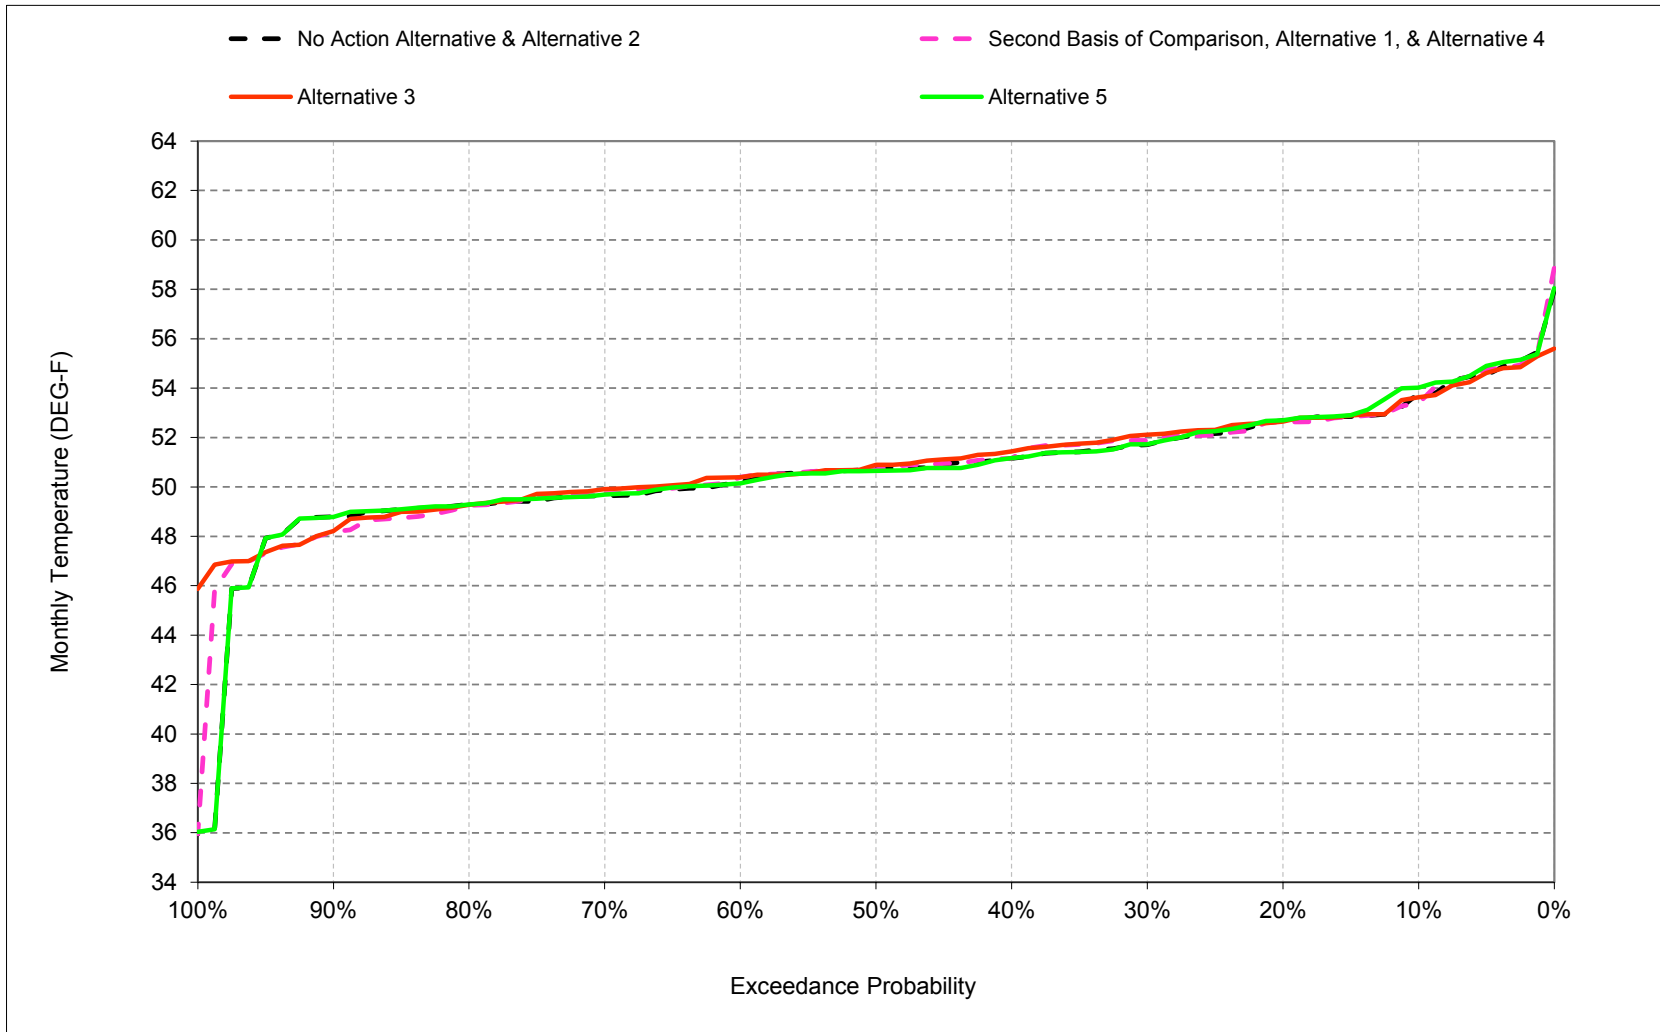


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-1-3. Trinity River below Lewiston Dam, December

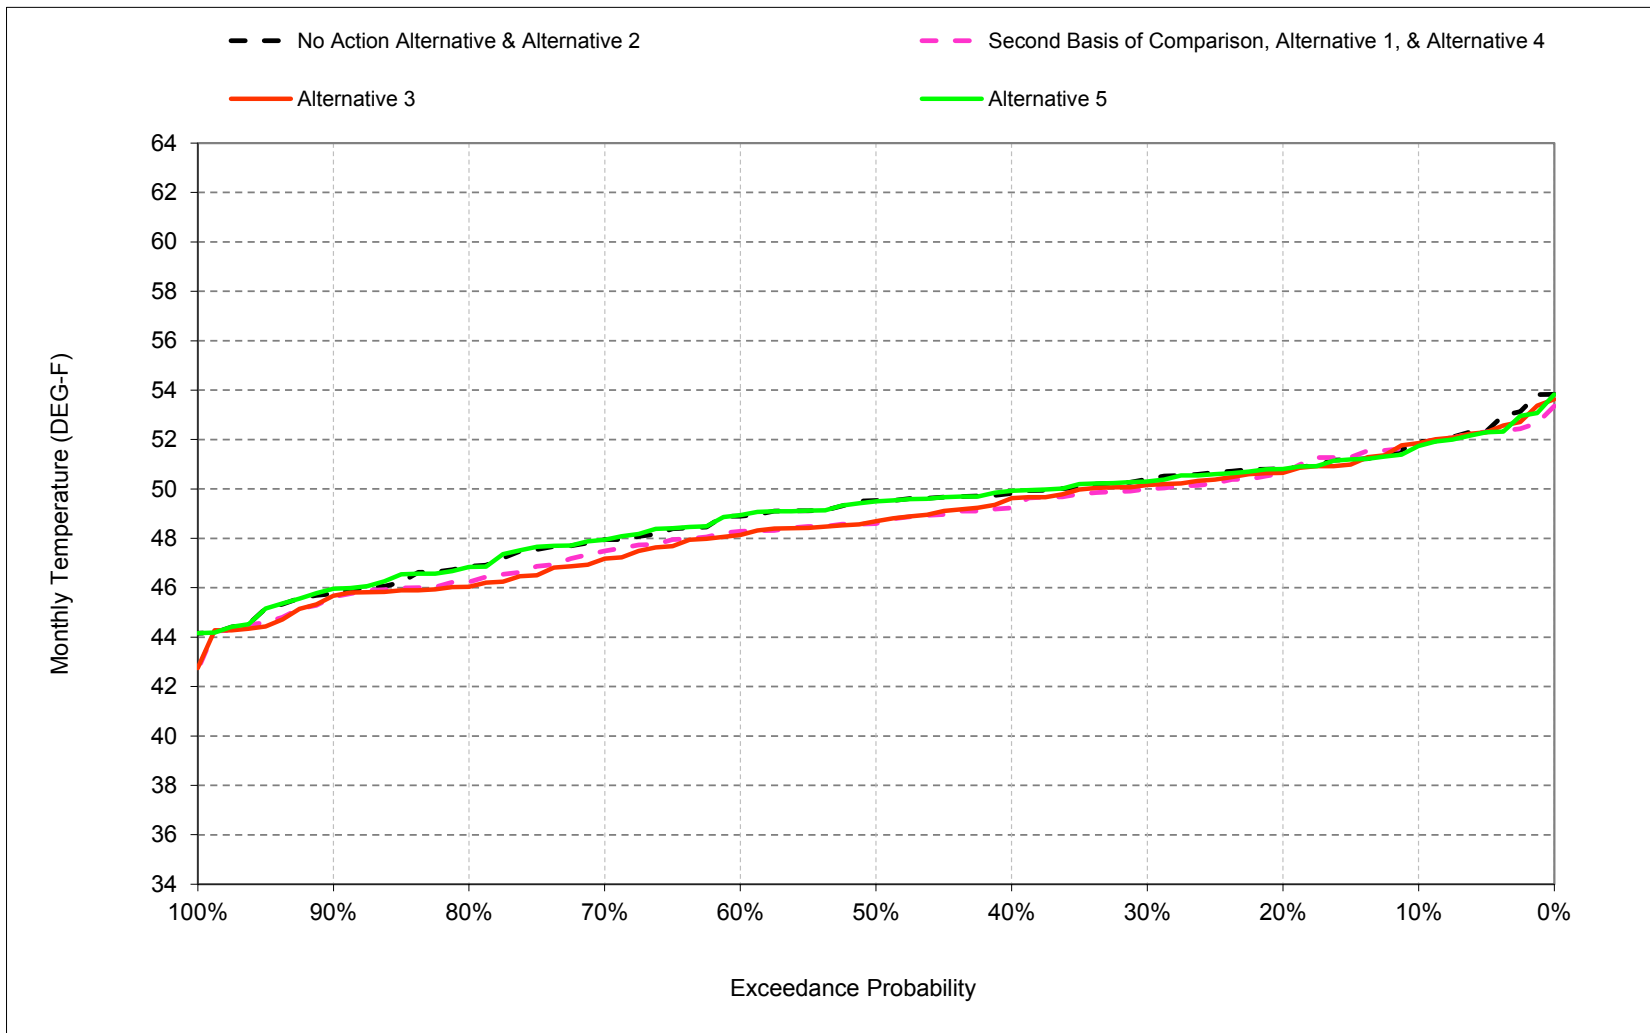


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-1-4. Trinity River below Lewiston Dam, January

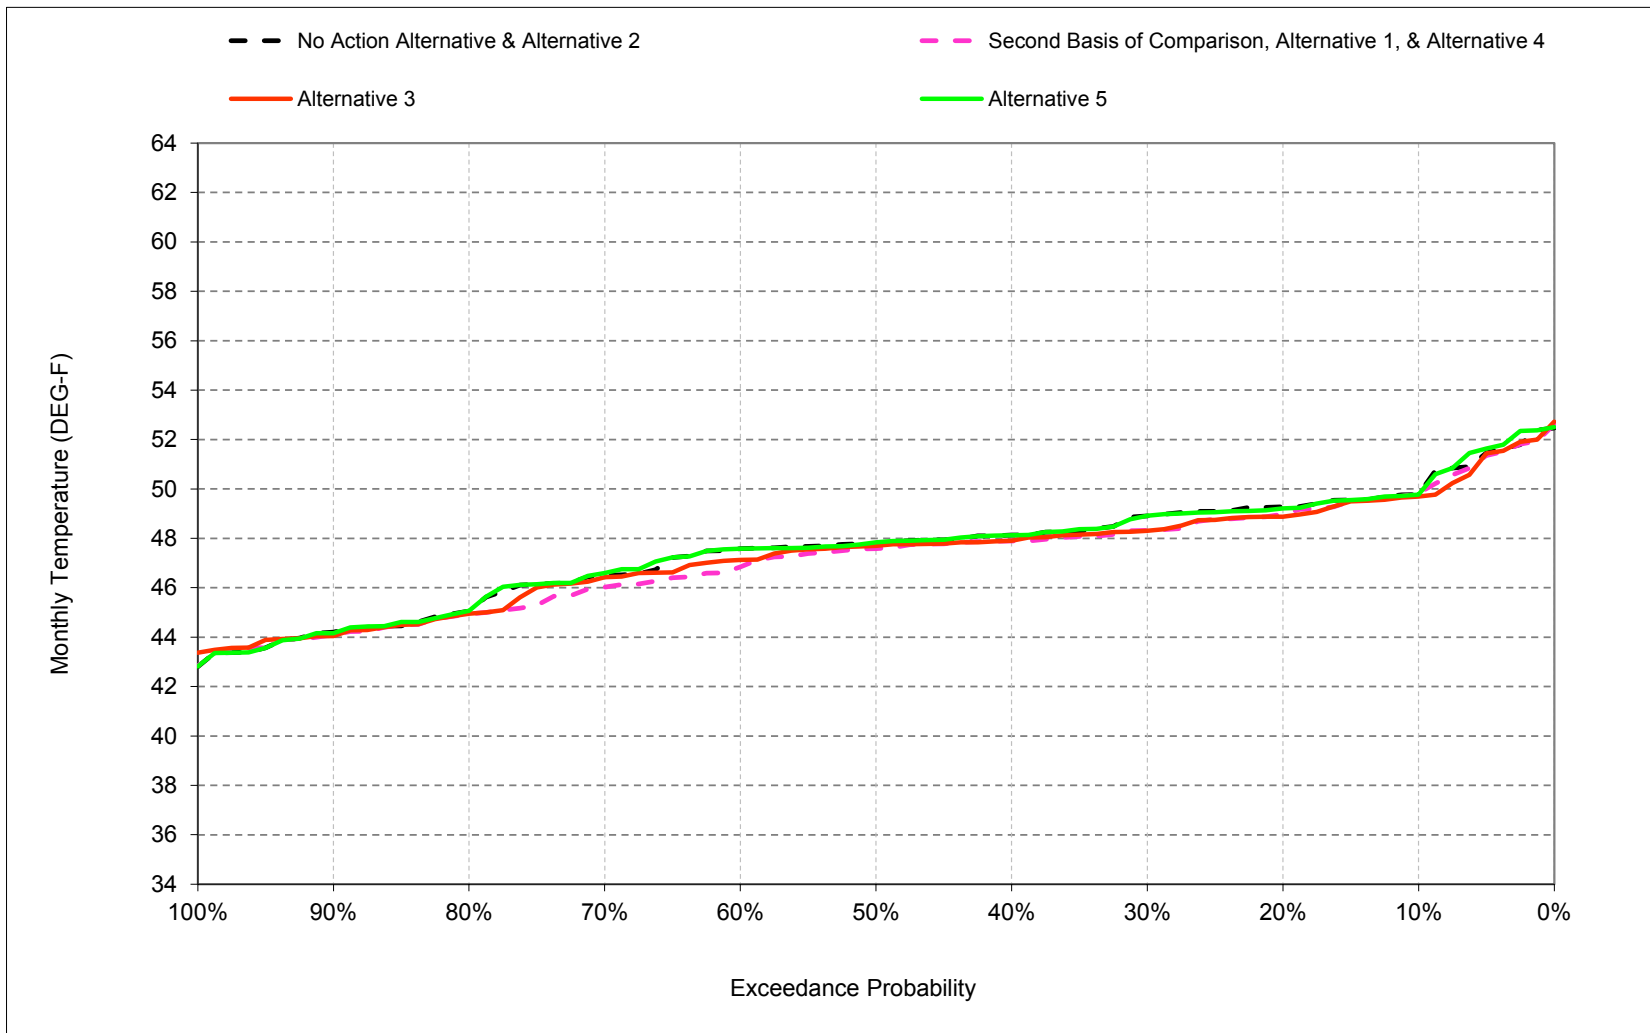


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-1-5. Trinity River below Lewiston Dam, February

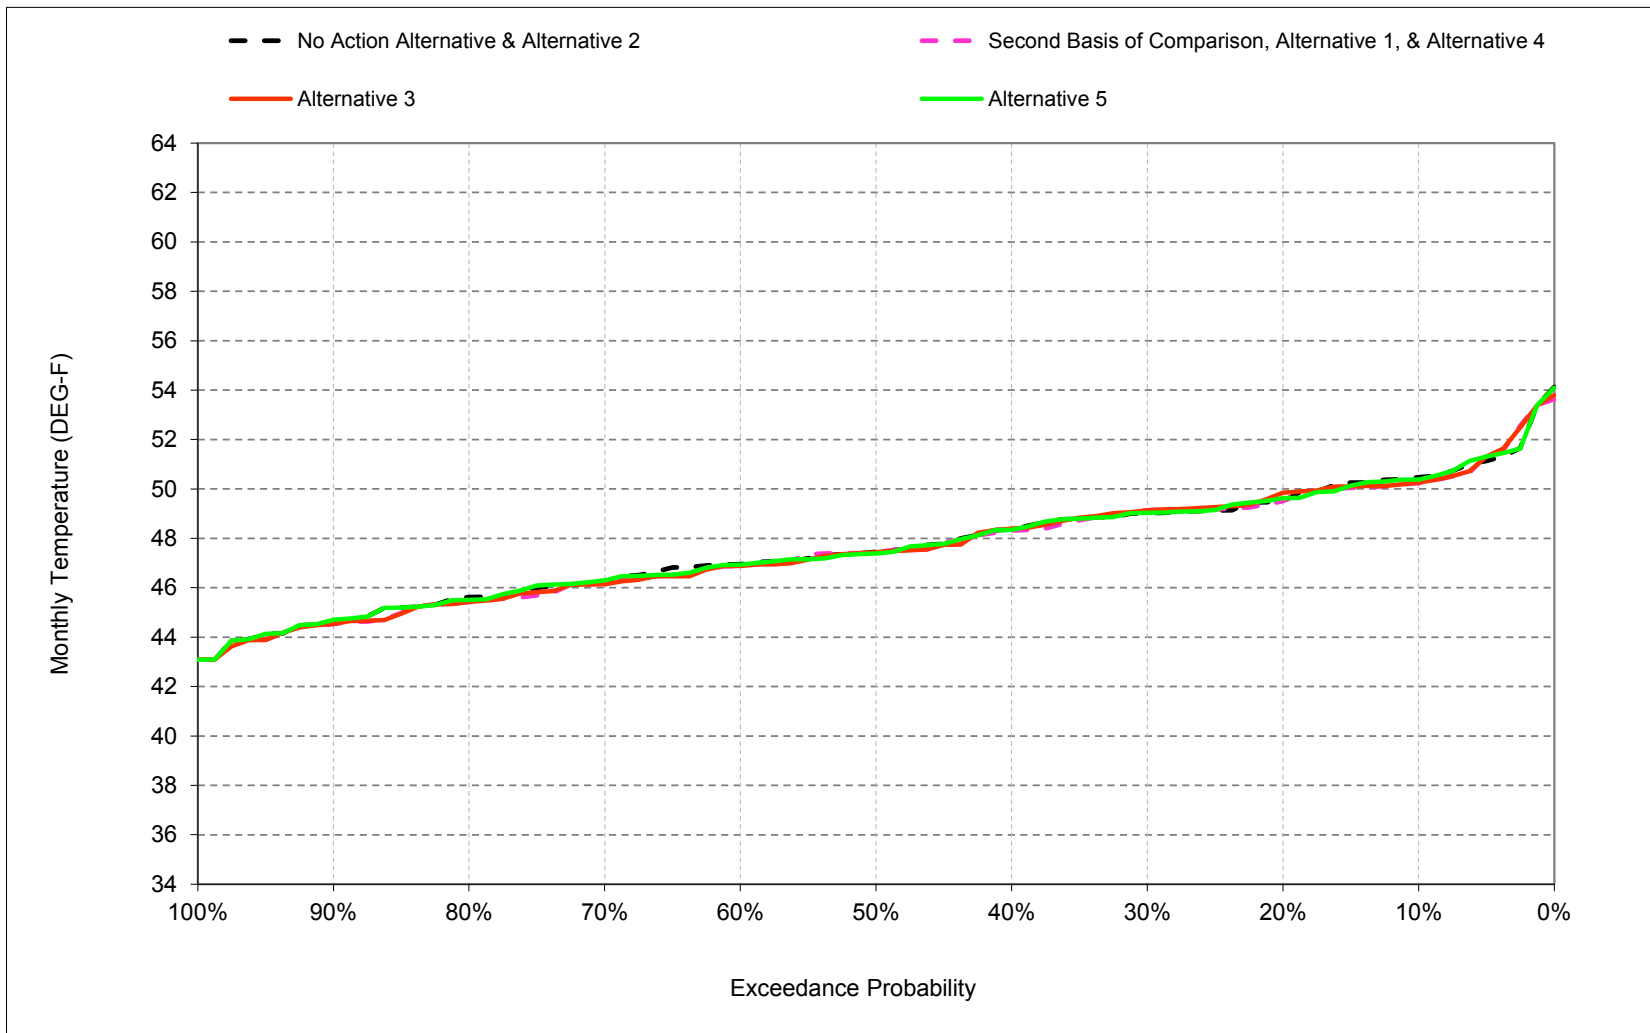


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-1-6. Trinity River below Lewiston Dam, March

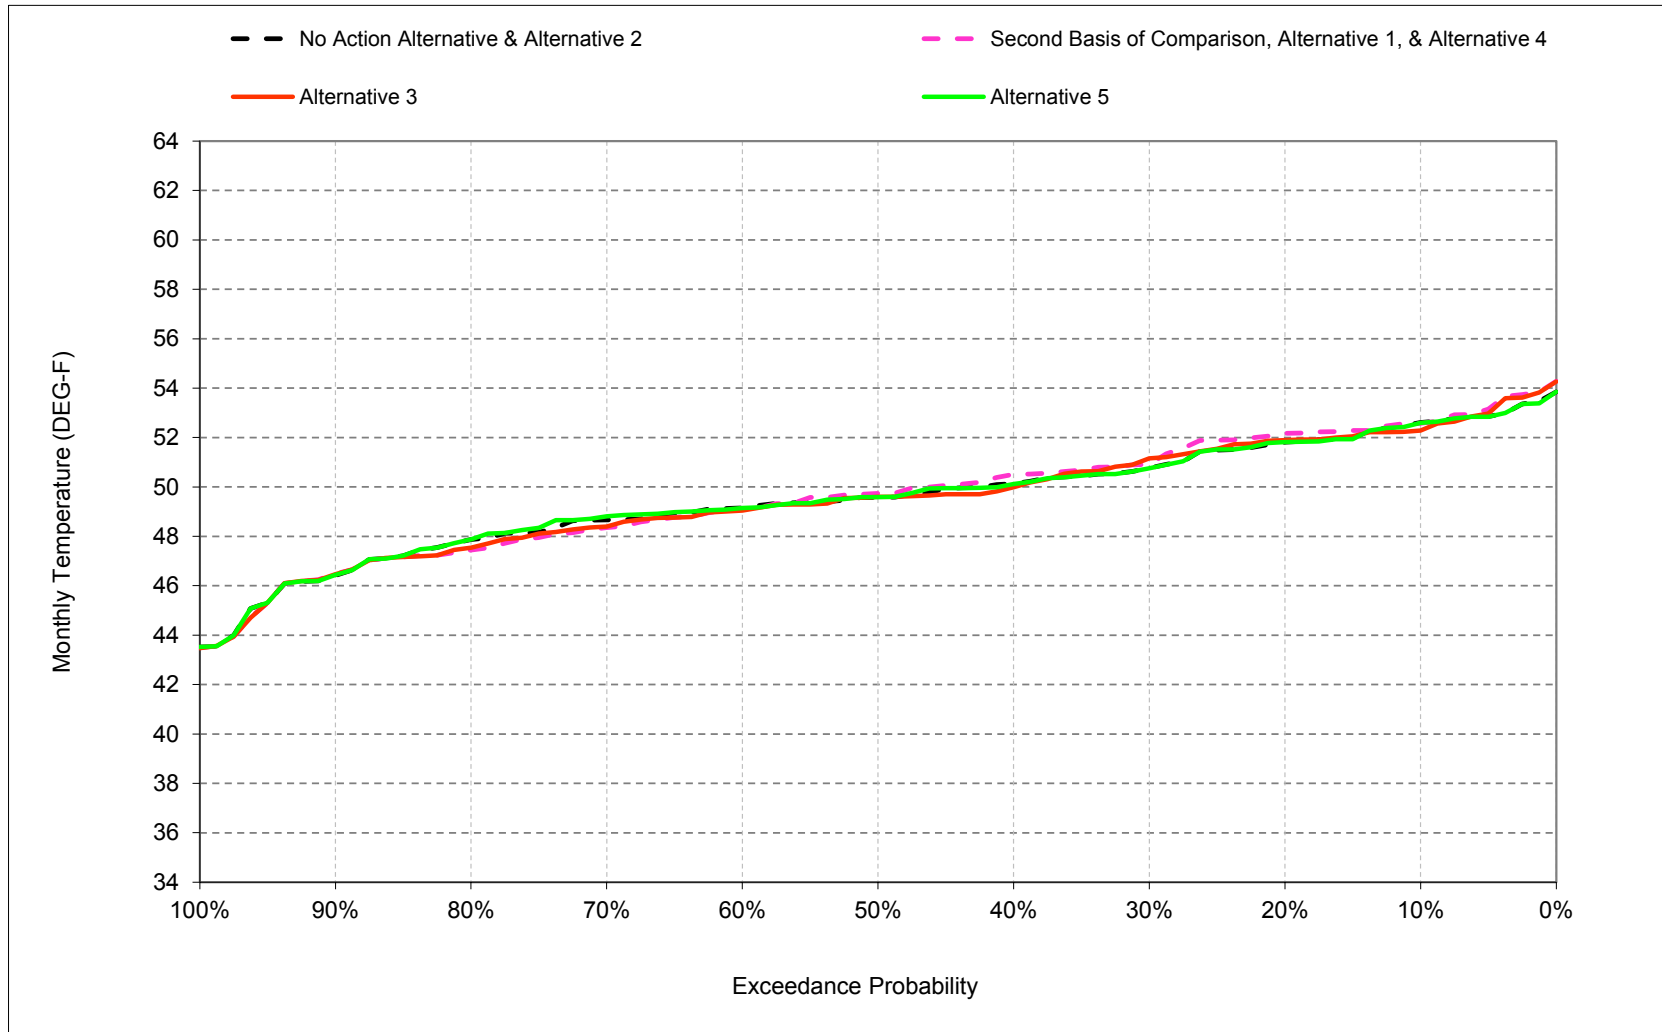


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-1-7. Trinity River below Lewiston Dam, April

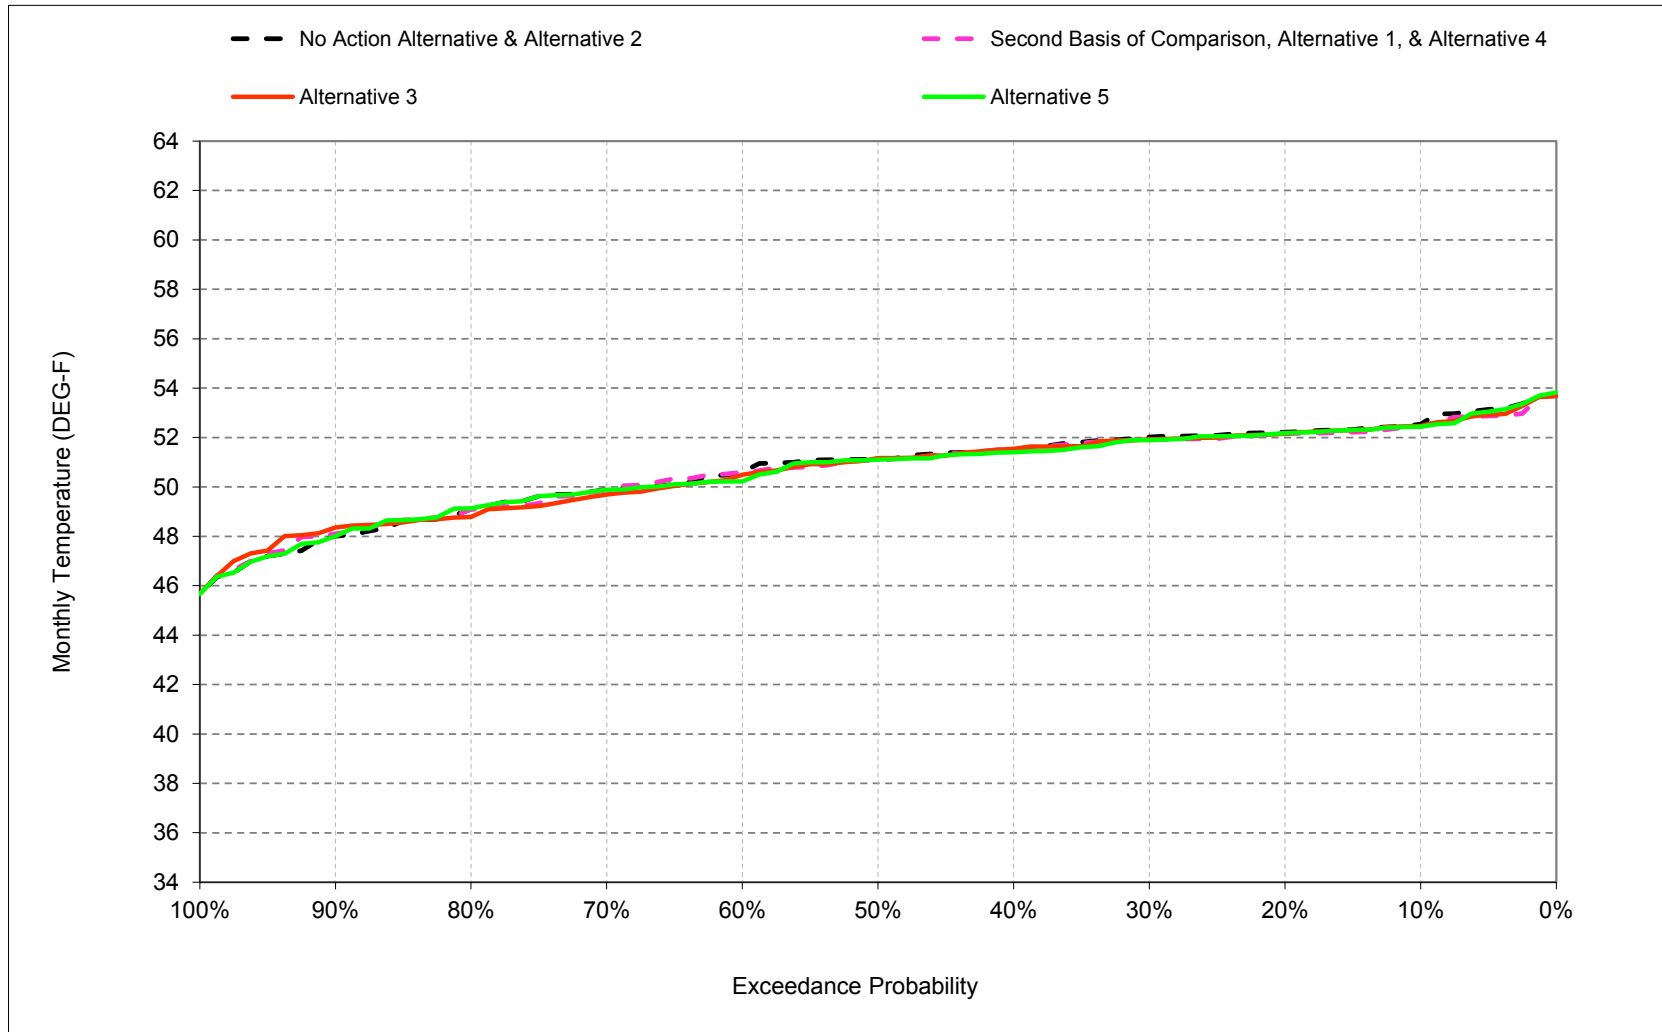


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-1-8. Trinity River below Lewiston Dam, May

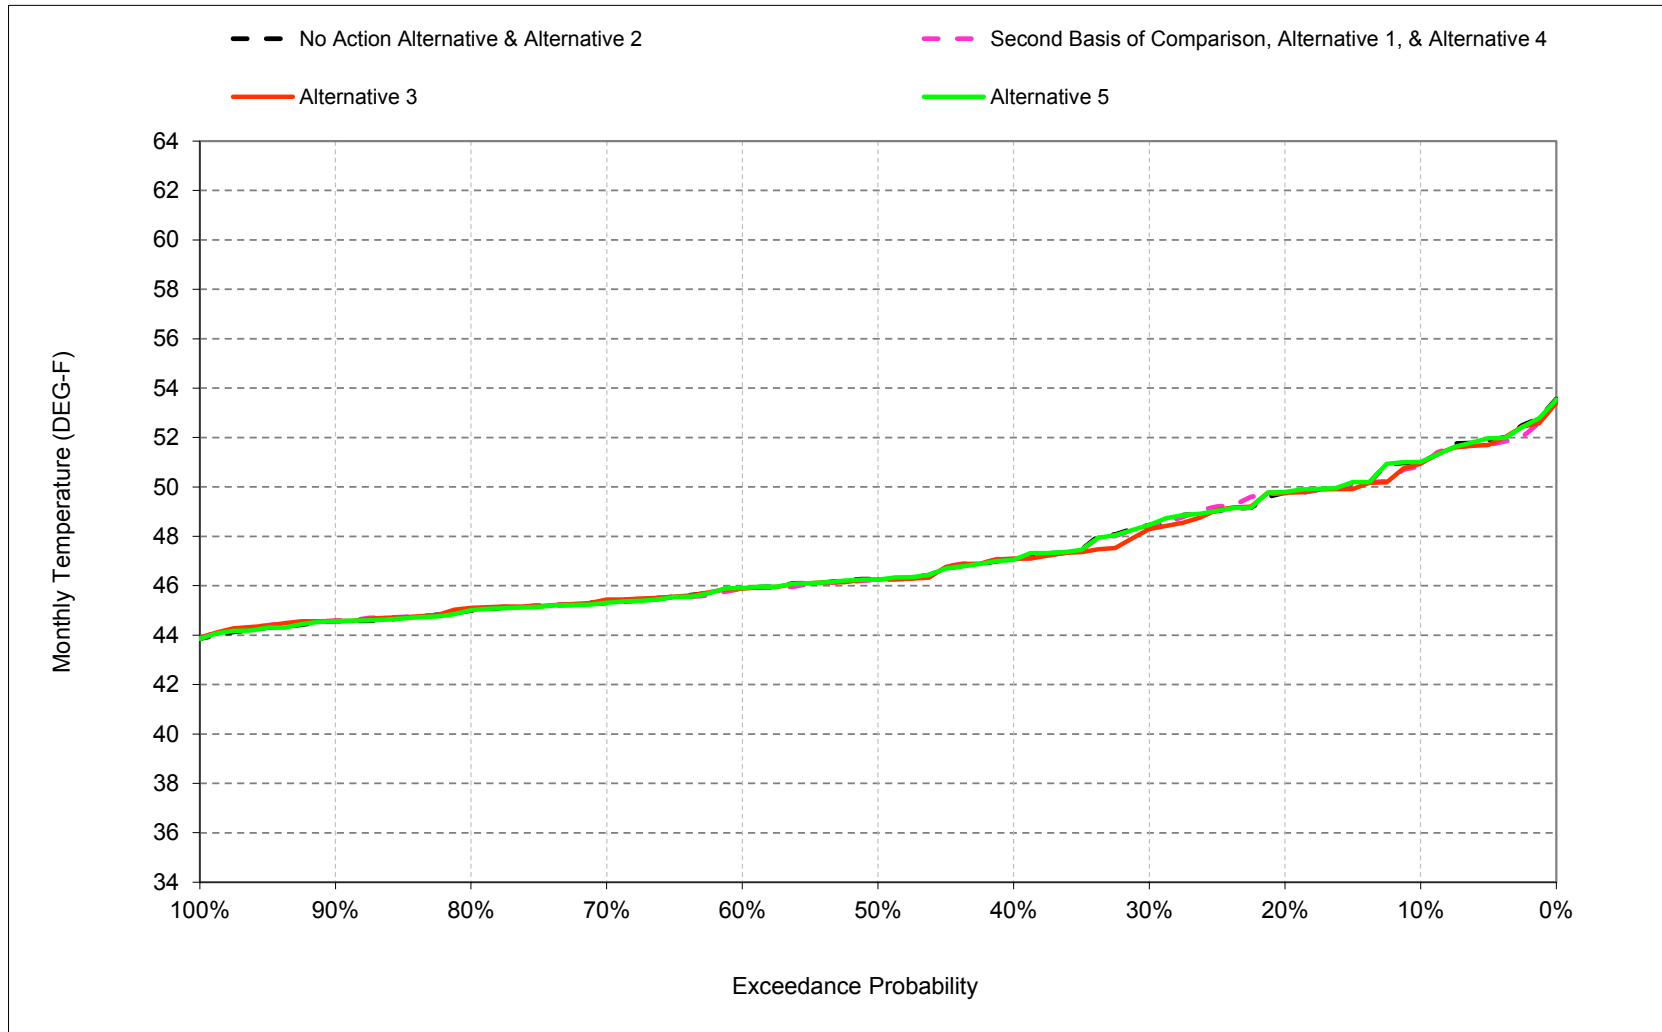


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-1-9. Trinity River below Lewiston Dam, June

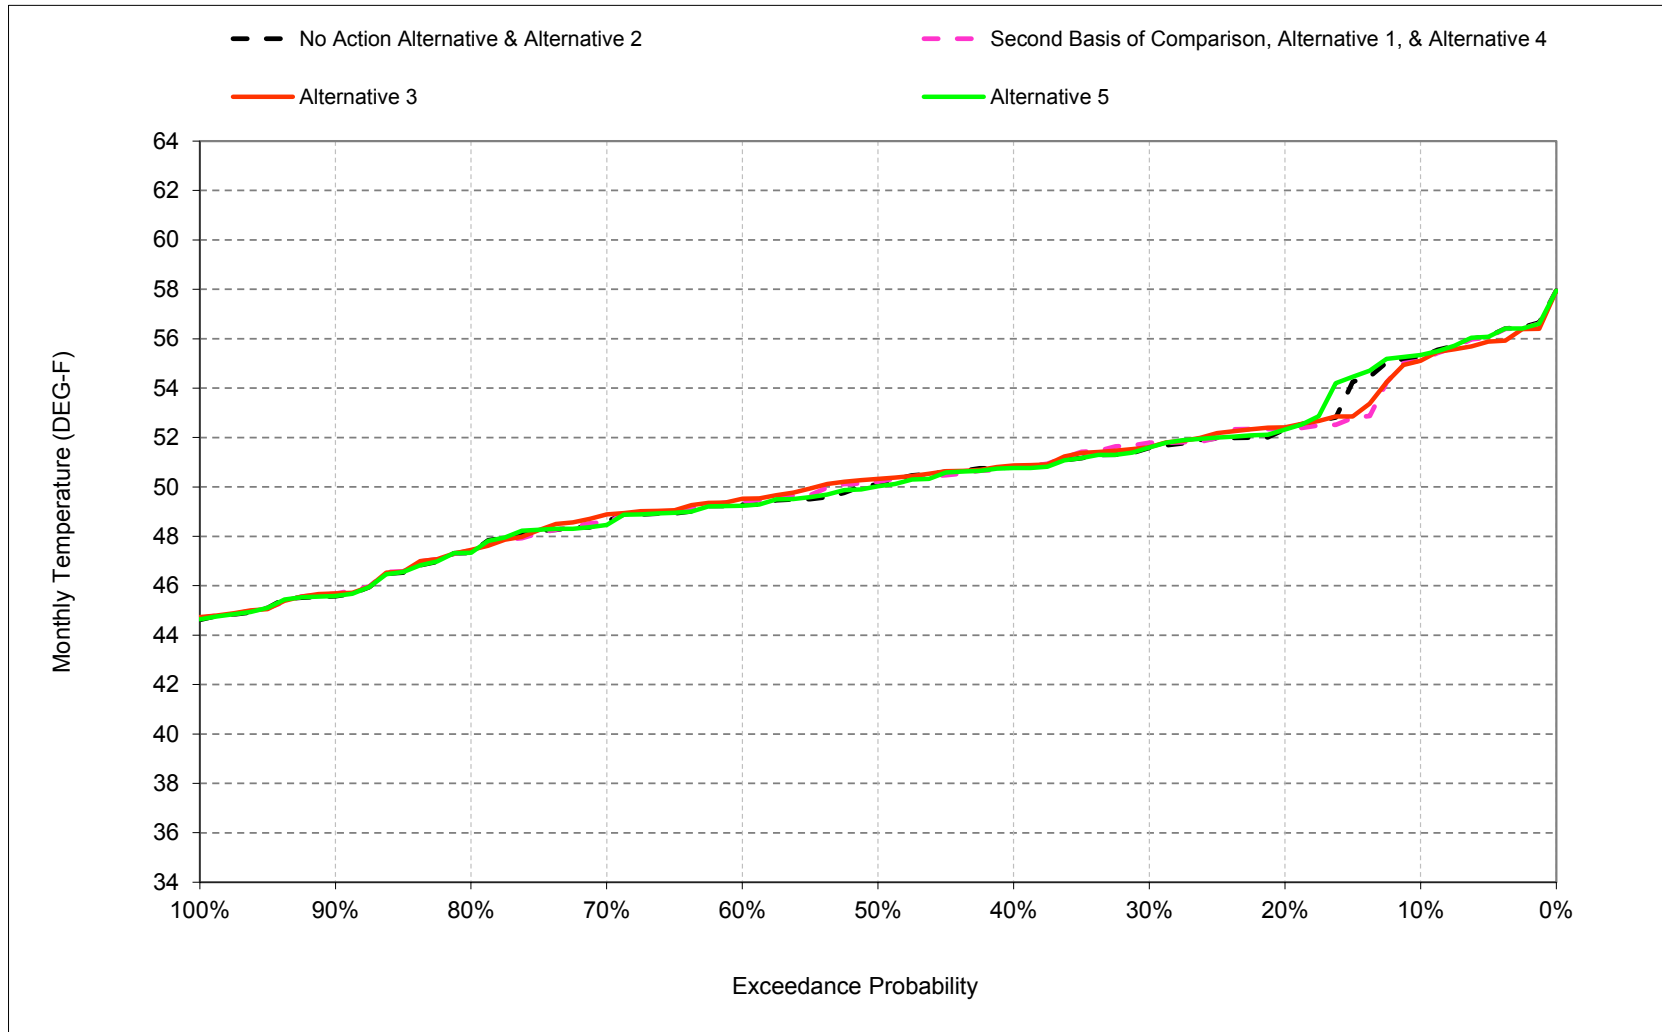


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-1-10. Trinity River below Lewiston Dam, July

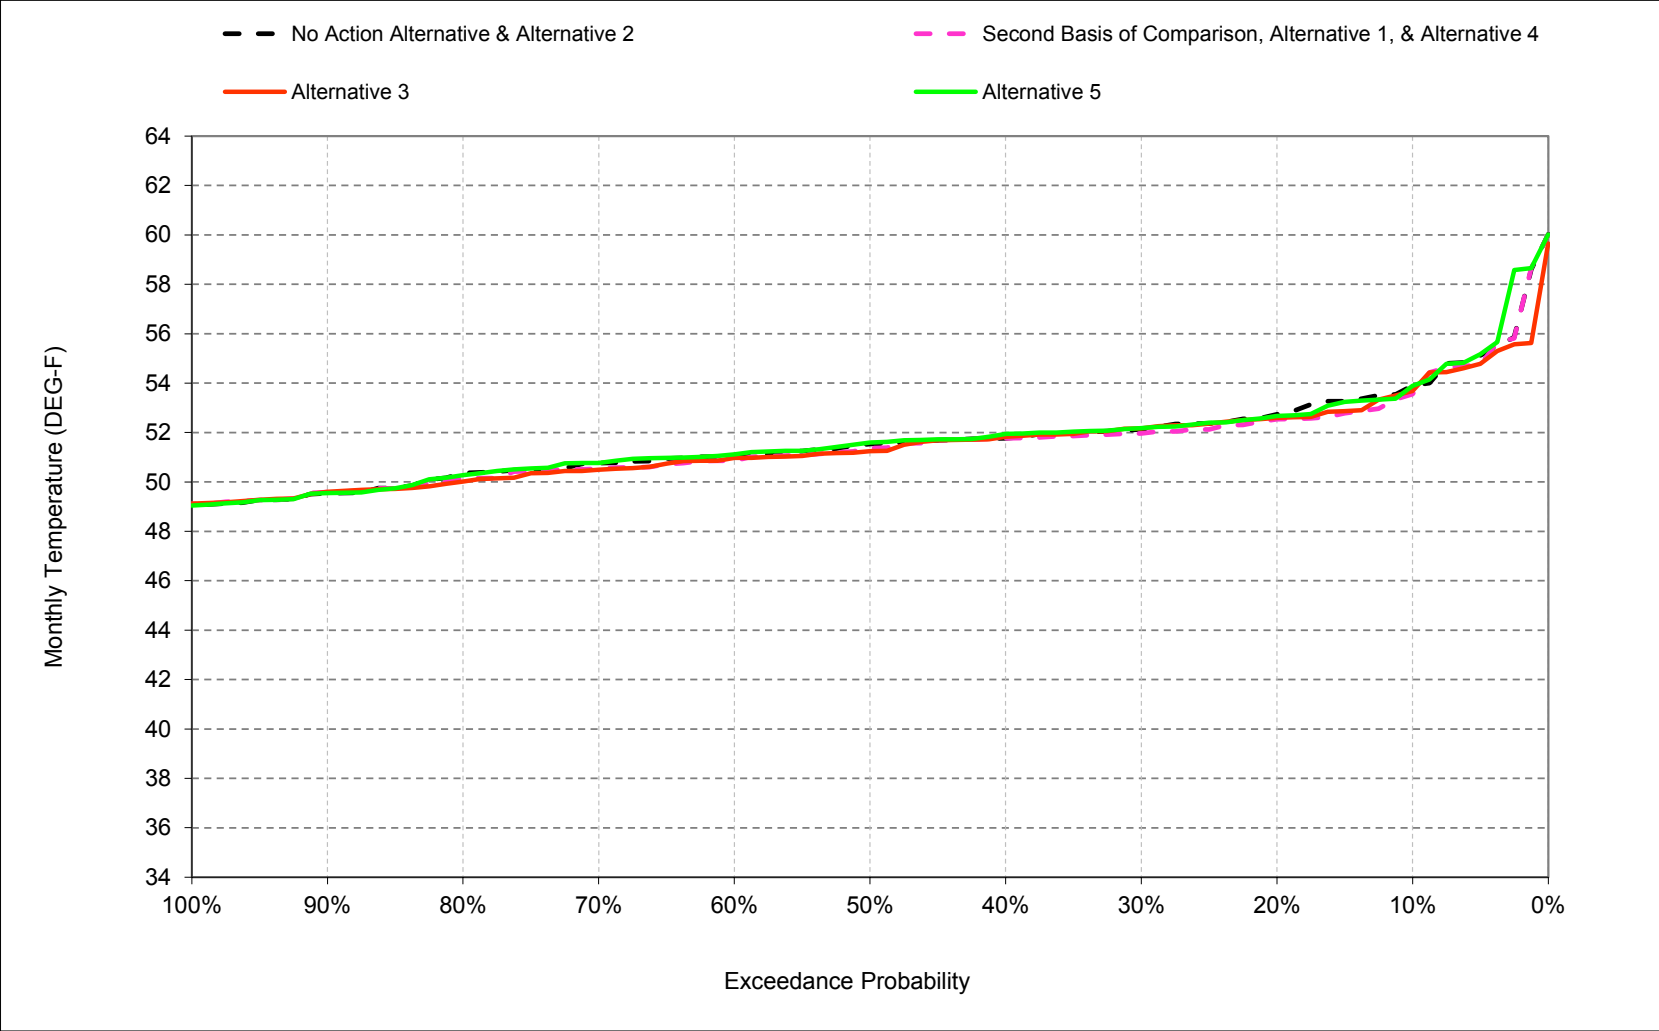


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-1-11. Trinity River below Lewiston Dam, August

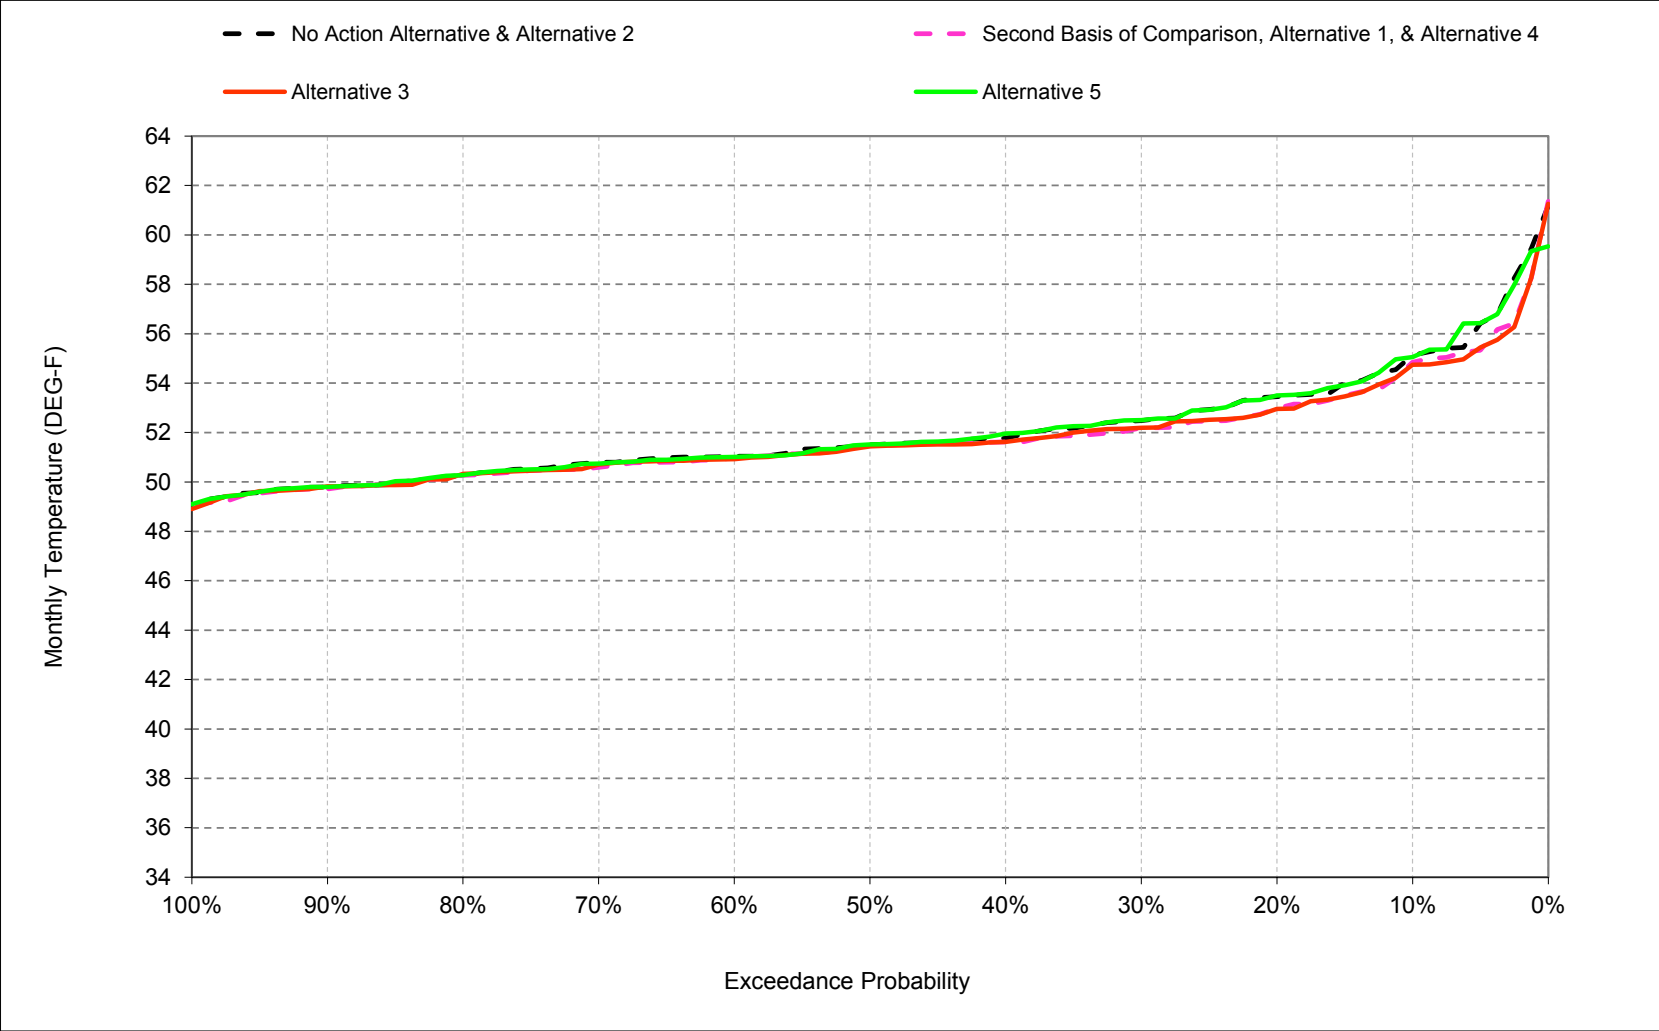

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-1-12. Trinity River below Lewiston Dam, September

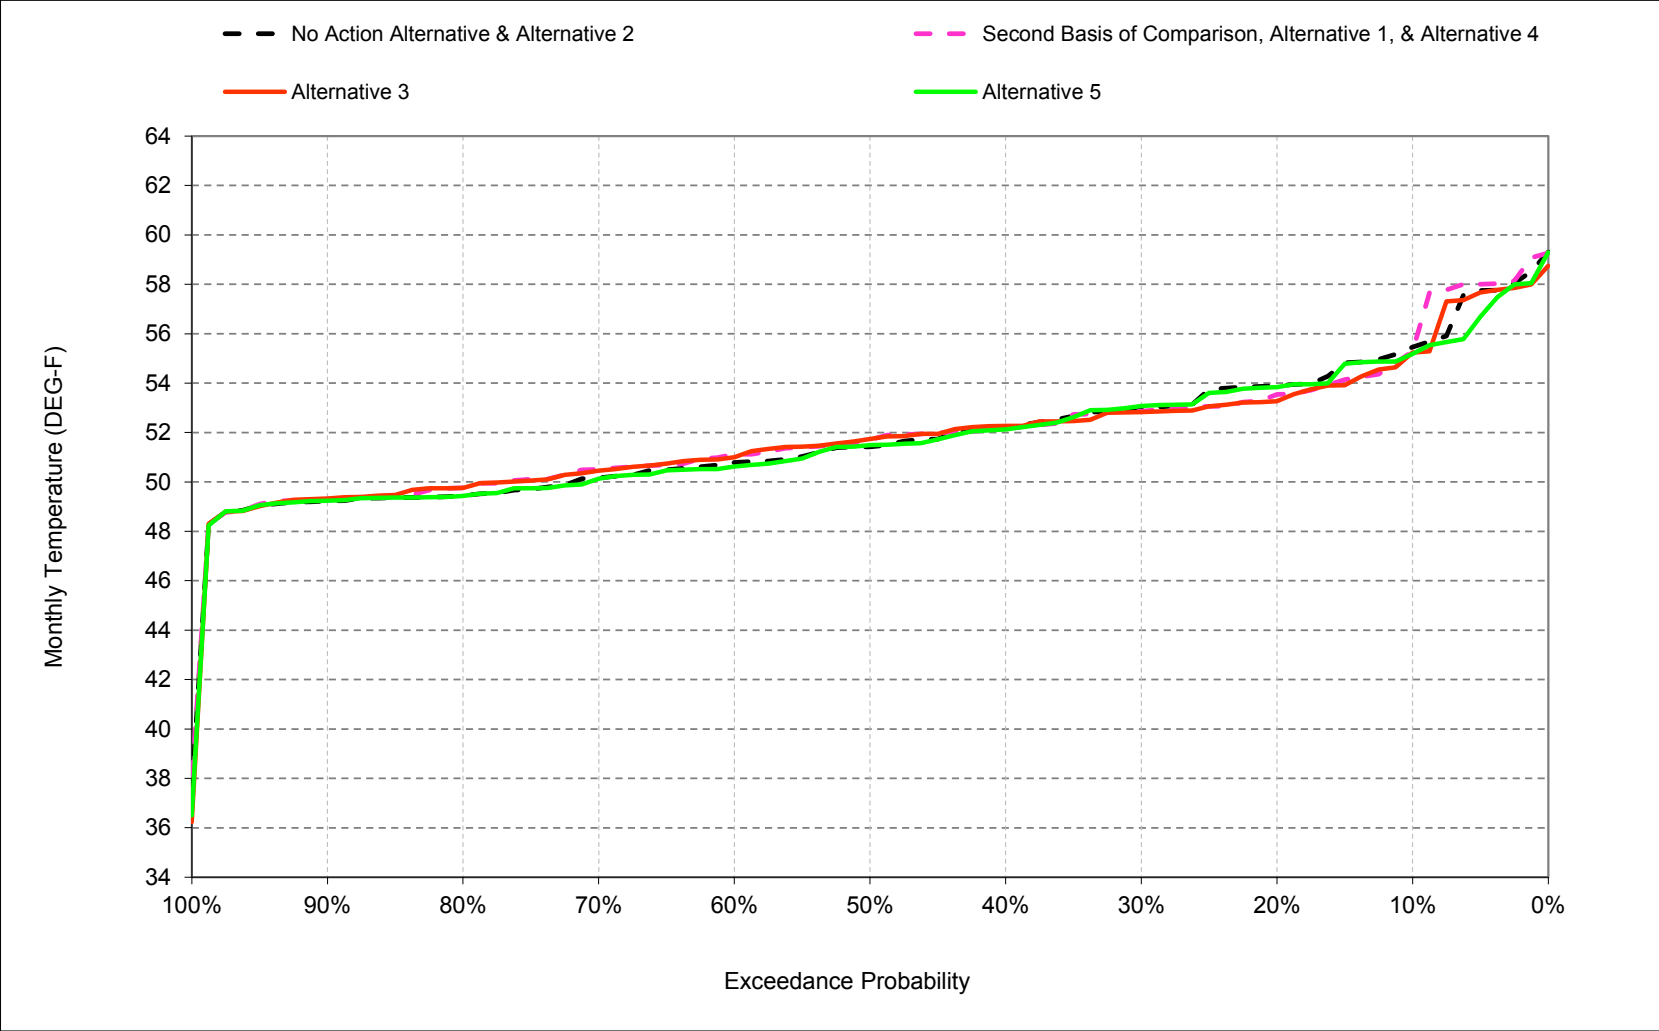

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-1-1. Trinity River below Lewiston Dam, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	56	54	52	50	50	53	53	51	55	54	55	55
20%	55	53	51	49	49	52	52	50	52	53	53	54
30%	54	52	50	49	49	51	52	48	52	52	52	53
40%	53	51	50	48	48	50	51	47	51	52	52	52
50%	52	51	50	48	47	50	51	46	50	52	51	51
60%	51	50	49	48	47	49	51	46	49	51	51	51
70%	50	50	48	46	46	49	50	45	48	51	51	50
80%	50	49	47	45	46	48	49	45	47	50	50	49
90%	49	49	46	44	45	46	48	45	46	50	50	49
Long Term												
Full Simulation Period ^b	52	51	49	47	48	49	51	47	50	52	52	52
Water Year Types ^c												
Wet (32%)	49	48	46	46	46	48	49	46	48	51	51	50
Above Normal (16%)	53	51	49	47	46	49	50	45	48	51	50	50
Below Normal (13%)	51	51	50	48	48	50	52	47	50	51	52	53
Dry (24%)	52	51	50	48	49	51	52	48	52	52	53	53
Critical (15%)	55	50	51	49	49	51	52	50	55	55	56	55

Alternative 1												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	55	53	52	50	50	53	52	51	55	54	55	55
20%	55	53	51	49	49	52	52	50	52	53	53	53
30%	54	52	50	48	49	51	52	48	52	52	52	53
40%	53	51	49	48	48	50	52	47	51	52	52	52
50%	52	51	49	48	47	50	51	46	50	51	51	52
60%	51	50	48	47	47	49	51	46	49	51	51	51
70%	51	50	47	46	46	48	50	45	49	51	51	50
80%	50	49	46	45	45	47	49	45	47	50	50	50
90%	49	48	46	44	44	46	48	45	46	50	50	49
Long Term												
Full Simulation Period ^b	52	51	49	47	48	50	51	47	50	52	52	52
Water Year Types ^c												
Wet (32%)	49	48	45	46	46	48	49	46	48	51	51	51
Above Normal (16%)	53	51	48	46	47	49	50	45	48	50	50	50
Below Normal (13%)	52	50	48	48	47	50	51	47	50	51	52	52
Dry (24%)	52	51	50	48	49	51	52	48	52	52	52	53
Critical (15%)	55	52	51	49	50	52	52	50	55	55	55	55

Alternative 1 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.3	-0.4	-0.1	0.1	-0.2	0.0	-0.1	-0.2	-0.1	-0.3	-0.3	-0.2
0.2	-0.3	-0.1	-0.2	-0.3	0.0	0.4	-0.1	0.0	0.1	-0.2	-0.5	-0.4
0.3	-0.7	0.2	-0.4	-0.6	0.1	0.2	-0.1	0.0	0.2	-0.2	-0.3	0.0
0.4	-0.4	0.0	-0.6	-0.2	-0.1	0.3	0.0	0.1	0.0	0.0	-0.2	0.0
0.5	0.1	-0.1	-0.9	-0.2	0.0	0.1	-0.1	0.0	0.1	-0.2	0.0	0.2
0.6	0.5	0.2	-0.6	-0.8	-0.1	-0.1	0.0	-0.1	0.1	-0.2	-0.1	0.3
0.7	0.2	0.1	-0.5	-0.5	0.0	-0.4	0.0	0.0	0.1	-0.2	-0.2	0.3
0.8	0.3	0.0	-0.6	-0.1	-0.2	-0.4	0.0	0.1	0.0	-0.1	-0.1	0.3
0.9	0.0	-0.6	-0.1	-0.1	0.0	0.0	0.1	0.0	0.1	0.0	-0.1	0.0
Long Term												
Full Simulation Period ^b	-0.1	0.1	-0.4	-0.3	-0.1	0.1	0.0	0.0	0.0	-0.1	-0.2	0.1
Water Year Types ^c												
Wet (32%)	-0.1	-0.1	-0.4	-0.2	-0.2	-0.1	0.1	0.0	0.0	-0.1	-0.1	0.6
Above Normal (16%)	-0.2	-0.7	-0.6	-0.9	0.1	0.0	0.1	0.1	0.1	-0.2	-0.3	-0.3
Below Normal (13%)	0.3	-0.8	-1.5	-0.5	-0.4	0.1	-0.5	0.1	0.1	-0.3	-0.2	-0.4
Dry (24%)	-0.4	0.0	-0.1	-0.1	-0.1	0.3	-0.1	0.0	0.1	-0.1	-0.1	-0.2
Critical (15%)	-0.2	2.4	0.2	0.0	0.3	0.1	0.0	-0.2	-0.4	-0.2	-0.7	0.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-1-2. Trinity River below Lewiston Dam, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	56	54	52	50	50	53	53	51	55	54	55	55
20%	55	53	51	49	49	52	52	50	52	53	53	54
30%	54	52	50	49	49	51	52	48	52	52	52	53
40%	53	51	50	48	48	50	51	47	51	52	52	52
50%	52	51	50	48	47	50	51	46	50	52	51	51
60%	51	50	49	48	47	49	51	46	49	51	51	51
70%	50	50	48	46	46	49	50	45	48	51	51	50
80%	50	49	47	45	46	48	49	45	47	50	50	49
90%	49	49	46	44	45	46	48	45	46	50	50	49
Long Term												
Full Simulation Period ^b	52	51	49	47	48	49	51	47	50	52	52	52
Water Year Types^c												
Wet (32%)	49	48	46	46	46	48	49	46	48	51	51	50
Above Normal (16%)	53	51	49	47	46	49	50	45	48	51	50	50
Below Normal (13%)	51	51	50	48	48	50	52	47	50	51	52	53
Dry (24%)	52	51	50	48	49	51	52	48	52	52	53	53
Critical (15%)	55	50	51	49	49	51	52	50	55	55	56	55
Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	55	54	52	50	50	52	52	51	55	54	55	55
20%	55	53	51	49	50	52	52	50	52	53	53	53
30%	54	52	50	48	49	51	52	48	52	52	52	53
40%	53	51	50	48	48	50	52	47	51	52	52	52
50%	52	51	49	48	47	50	51	46	50	51	51	52
60%	51	50	48	47	47	49	50	46	49	51	51	51
70%	50	50	47	46	46	48	50	45	49	50	51	50
80%	50	49	46	45	45	47	49	45	47	50	50	50
90%	49	48	46	44	44	46	48	45	46	50	50	49
Long Term												
Full Simulation Period ^b	52	51	49	47	48	49	51	47	50	52	52	52
Water Year Types^c												
Wet (32%)	49	48	45	46	46	48	49	46	48	51	51	51
Above Normal (16%)	53	51	48	46	46	49	50	45	48	50	50	50
Below Normal (13%)	51	50	48	48	47	50	51	47	50	51	52	52
Dry (24%)	52	51	49	48	49	51	52	48	52	52	52	53
Critical (15%)	55	53	51	49	50	52	52	50	55	54	55	54
Alternative 3 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
0.1	-0.3	-0.2	-0.1	-0.1	-0.2	-0.3	-0.1	-0.1	-0.2	-0.2	-0.4	-0.3
0.2	-0.5	0.0	-0.2	-0.4	0.3	0.1	-0.1	0.0	0.1	-0.1	-0.5	-0.6
0.3	-0.6	0.4	-0.2	-0.6	0.1	0.4	-0.1	-0.2	0.1	0.0	-0.3	-0.1
0.4	-0.5	0.3	-0.2	-0.2	0.0	-0.2	0.0	0.1	0.1	0.0	-0.2	0.1
0.5	0.0	0.1	-0.8	-0.1	0.0	0.0	0.0	0.0	0.2	-0.3	-0.1	0.3
0.6	0.2	0.2	-0.8	-0.4	-0.1	-0.1	-0.2	0.0	0.2	-0.1	-0.1	0.2
0.7	0.1	0.3	-0.8	-0.2	0.0	-0.3	-0.2	0.0	0.3	-0.3	-0.2	0.2
0.8	0.2	0.0	-0.8	-0.1	-0.2	-0.3	-0.1	0.1	0.0	-0.3	-0.1	0.3
0.9	-0.1	-0.6	-0.1	-0.1	0.0	0.0	0.3	0.0	0.1	0.0	-0.1	0.1
Long Term												
Full Simulation Period ^b	-0.2	0.3	-0.4	-0.2	-0.1	0.0	0.0	0.0	0.0	-0.2	-0.2	0.0
Water Year Types^c												
Wet (32%)	-0.1	-0.1	-0.4	-0.1	-0.2	-0.1	0.2	0.0	0.0	0.0	-0.1	0.6
Above Normal (16%)	0.0	-0.4	-0.6	-0.7	0.0	-0.1	0.0	0.1	0.3	-0.2	-0.1	-0.2
Below Normal (13%)	0.1	-0.7	-1.5	-0.6	-0.5	0.1	-0.6	0.1	0.1	0.0	-0.2	-0.5
Dry (24%)	-0.4	0.0	-0.3	0.0	-0.1	0.0	-0.1	-0.1	0.2	-0.2	-0.2	-0.2
Critical (15%)	-0.8	3.3	0.3	0.3	0.6	0.0	0.0	-0.2	-0.4	-0.5	-0.8	-0.3

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
^b Based on the 82-year simulation period.
^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-1-3. Trinity River below Lewiston Dam, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	56	54	52	50	50	53	53	51	55	54	55	55
20%	55	53	51	49	49	52	52	50	52	53	53	54
30%	54	52	50	49	49	51	52	48	52	52	52	53
40%	53	51	50	48	48	50	51	47	51	52	52	52
50%	52	51	50	48	47	50	51	46	50	52	51	51
60%	51	50	49	48	47	49	51	46	49	51	51	51
70%	50	50	48	46	46	49	50	45	48	51	51	50
80%	50	49	47	45	46	48	49	45	47	50	50	49
90%	49	49	46	44	45	46	48	45	46	50	50	49
Long Term												
Full Simulation Period ^b	52	51	49	47	48	49	51	47	50	52	52	52
Water Year Types^c												
Wet (32%)	49	48	46	46	46	48	49	46	48	51	51	50
Above Normal (16%)	53	51	49	47	46	49	50	45	48	51	50	50
Below Normal (13%)	51	51	50	48	48	50	52	47	50	51	52	53
Dry (24%)	52	51	50	48	49	51	52	48	52	52	53	53
Critical (15%)	55	50	51	49	49	51	52	50	55	55	56	55

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	56	54	52	50	50	53	52	51	55	54	55	55
20%	55	53	51	49	50	52	52	50	52	53	53	54
30%	54	52	50	49	49	51	52	48	52	52	52	53
40%	53	51	50	48	48	50	51	47	51	52	52	52
50%	52	51	49	48	47	50	51	46	50	52	51	51
60%	51	50	49	48	47	49	50	46	49	51	51	51
70%	50	50	48	47	46	49	50	45	48	51	51	50
80%	50	49	47	45	46	48	49	45	47	50	50	49
90%	49	49	46	44	45	46	48	45	46	50	50	49
Long Term												
Full Simulation Period ^b	52	51	49	48	48	50	51	47	50	52	52	52
Water Year Types^c												
Wet (32%)	49	48	46	46	46	48	49	46	48	51	51	50
Above Normal (16%)	53	51	49	47	46	49	50	45	48	51	50	50
Below Normal (13%)	51	51	50	48	48	50	51	47	50	51	52	52
Dry (24%)	52	51	50	48	49	51	52	48	52	52	53	53
Critical (15%)	56	50	51	49	49	51	52	50	56	55	56	54

Alternative 5 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
0.1	0.0	0.2	-0.2	0.0	-0.1	0.0	-0.1	0.0	0.1	0.0	0.0	-0.3
0.2	-0.2	0.0	0.0	-0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
0.3	-0.1	0.0	-0.1	0.0	0.0	0.0	-0.1	0.0	0.0	0.1	0.0	0.1
0.4	0.1	0.0	0.1	0.0	0.0	0.0	-0.1	0.0	0.0	0.1	0.1	-0.1
0.5	0.0	-0.1	0.0	0.0	-0.1	0.0	0.0	0.0	-0.1	0.0	0.0	0.0
0.6	0.0	-0.1	0.0	0.0	0.0	0.0	-0.3	0.0	0.0	0.0	0.0	-0.2
0.7	0.0	0.1	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0
0.8	0.0	0.0	0.0	0.0	-0.1	0.0	0.2	0.0	0.0	0.0	0.0	0.0
0.9	0.0	0.0	0.2	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	-0.1
Water Year Types^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	-0.1	0.0	0.0
Above Normal (16%)	0.4	0.1	-0.2	0.1	0.0	0.0	0.1	0.0	0.0	0.0	0.1	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	-0.1	0.0	-0.5	0.1	0.0	0.0	0.0	-0.2
Dry (24%)	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0
Critical (15%)	0.3	0.3	-0.1	0.1	0.0	0.0	-0.1	0.0	0.2	0.4	-0.1	-0.3

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-1-4. Trinity River below Lewiston Dam, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	55	53	52	50	50	53	52	51	55	54	55	55
20%	55	53	51	49	49	52	52	50	52	53	53	53
30%	54	52	50	48	49	51	52	48	52	52	52	53
40%	53	51	49	48	48	50	52	47	51	52	52	52
50%	52	51	49	48	47	50	51	46	50	51	51	52
60%	51	50	48	47	47	49	51	46	49	51	51	51
70%	51	50	47	46	46	48	50	45	49	51	51	50
80%	50	49	46	45	45	47	49	45	47	50	50	50
90%	49	48	46	44	44	46	48	45	46	50	50	49
Long Term												
Full Simulation Period ^b	52	51	49	47	48	50	51	47	50	52	52	52
Water Year Types^c												
Wet (32%)	49	48	45	46	46	48	49	46	48	51	51	51
Above Normal (16%)	53	51	48	46	47	49	50	45	48	50	50	50
Below Normal (13%)	52	50	48	48	47	50	51	47	50	51	52	52
Dry (24%)	52	51	50	48	49	51	52	48	52	52	52	53
Critical (15%)	55	52	51	49	50	52	52	50	55	55	55	55

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	56	54	52	50	50	53	53	51	55	54	55	55
20%	55	53	51	49	49	52	52	50	52	53	53	54
30%	54	52	50	49	49	51	52	48	52	52	52	53
40%	53	51	50	48	48	50	51	47	51	52	52	52
50%	52	51	50	48	47	50	51	46	50	52	51	51
60%	51	50	49	48	47	49	51	46	49	51	51	51
70%	50	50	48	46	46	49	50	45	48	51	51	50
80%	50	49	47	45	46	48	49	45	47	50	50	49
90%	49	49	46	44	45	46	48	45	46	50	50	49
Long Term												
Full Simulation Period ^b	52	51	49	47	48	49	51	47	50	52	52	52
Water Year Types^c												
Wet (32%)	49	48	46	46	46	48	49	46	48	51	51	50
Above Normal (16%)	53	51	49	47	46	49	50	45	48	51	50	50
Below Normal (13%)	51	51	50	48	48	50	52	47	50	51	52	53
Dry (24%)	52	51	50	48	49	51	52	48	52	52	53	53
Critical (15%)	55	50	51	49	49	51	52	50	55	55	56	55

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
0.1	0.3	0.4	0.1	-0.1	0.2	0.0	0.1	0.2	0.1	0.3	0.3	0.2
0.2	0.3	0.1	0.2	0.3	0.0	-0.4	0.1	0.0	-0.1	0.2	0.5	0.4
0.3	0.7	-0.2	0.4	0.6	-0.1	-0.2	0.1	0.0	-0.2	0.2	0.3	0.0
0.4	0.4	0.0	0.6	0.2	0.1	-0.3	0.0	-0.1	0.0	0.0	0.2	0.0
0.5	-0.1	0.1	0.9	0.2	0.0	-0.1	0.1	0.0	-0.1	0.2	0.0	-0.2
0.6	-0.5	-0.2	0.6	0.8	0.1	0.1	0.0	0.1	-0.1	0.2	0.1	-0.3
0.7	-0.2	-0.1	0.5	0.5	0.0	0.4	0.0	0.0	-0.1	0.2	0.2	-0.3
0.8	-0.3	0.0	0.6	0.1	0.2	0.4	0.0	-0.1	0.0	0.1	0.1	-0.3
0.9	0.0	0.6	0.1	0.1	0.0	0.0	-0.1	0.0	-0.1	0.0	0.1	0.0
Long Term												
Full Simulation Period ^b	0.1	-0.1	0.4	0.3	0.1	-0.1	0.0	0.0	0.0	0.1	0.2	-0.1
Water Year Types^c												
Wet (32%)	0.1	0.1	0.4	0.2	0.2	0.1	-0.1	0.0	0.0	0.1	0.1	-0.6
Above Normal (16%)	0.2	0.7	0.6	0.9	-0.1	0.0	-0.1	-0.1	-0.1	0.2	0.3	0.3
Below Normal (13%)	-0.3	0.8	1.5	0.5	0.4	-0.1	0.5	-0.1	-0.1	0.3	0.2	0.4
Dry (24%)	0.4	0.0	0.1	0.1	0.1	-0.3	0.1	0.0	-0.1	0.1	0.1	0.2
Critical (15%)	0.2	-2.4	-0.2	0.0	-0.3	-0.1	0.0	0.2	0.4	0.2	0.7	-0.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-1-5. Trinity River below Lewiston Dam, Monthly Temperature

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	55	53	52	50	50	53	52	51	55	54	55	55
20%	55	53	51	49	49	52	52	50	52	53	53	53
30%	54	52	50	48	49	51	52	48	52	52	52	53
40%	53	51	49	48	48	50	52	47	51	52	52	52
50%	52	51	49	48	47	50	51	46	50	51	51	52
60%	51	50	48	47	47	49	51	46	49	51	51	51
70%	51	50	47	46	46	48	50	45	49	51	51	50
80%	50	49	46	45	45	47	49	45	47	50	50	50
90%	49	48	46	44	44	46	48	45	46	50	50	49
Long Term												
Full Simulation Period ^b	52	51	49	47	48	50	51	47	50	52	52	52
Water Year Types ^c												
Wet (32%)	49	48	45	46	46	48	49	46	48	51	51	51
Above Normal (16%)	53	51	48	46	47	49	50	45	48	50	50	50
Below Normal (13%)	52	50	48	48	47	50	51	47	50	51	52	52
Dry (24%)	52	51	50	48	49	51	52	48	52	52	52	53
Critical (15%)	55	52	51	49	50	52	52	50	55	55	55	55

Alternative 3

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	55	54	52	50	50	52	52	51	55	54	55	55
20%	55	53	51	49	50	52	52	50	52	53	53	53
30%	54	52	50	48	49	51	52	48	52	52	52	53
40%	53	51	50	48	48	50	52	47	51	52	52	52
50%	52	51	49	48	47	50	51	46	50	51	51	52
60%	51	50	48	47	47	49	50	46	49	51	51	51
70%	50	50	47	46	46	48	50	45	49	50	51	50
80%	50	49	46	45	45	47	49	45	47	50	50	50
90%	49	48	46	44	44	46	48	45	46	50	50	49
Long Term												
Full Simulation Period ^b	52	51	49	47	48	49	51	47	50	52	52	52
Water Year Types ^c												
Wet (32%)	49	48	45	46	46	48	49	46	48	51	51	51
Above Normal (16%)	53	51	48	46	46	49	50	45	48	50	50	50
Below Normal (13%)	51	50	48	48	47	50	51	47	50	51	52	52
Dry (24%)	52	51	49	48	49	51	52	48	52	52	52	53
Critical (15%)	55	53	51	49	50	52	52	50	55	54	55	54

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.0	0.2	0.1	-0.1	0.0	-0.3	0.0	0.1	0.0	0.1	-0.1	-0.1
0.2	-0.1	0.0	0.0	-0.1	0.3	-0.3	0.0	0.0	0.1	0.1	0.0	-0.2
0.3	0.1	0.2	0.2	0.0	0.0	0.2	0.0	-0.2	-0.2	0.2	0.0	0.0
0.4	0.0	0.3	0.4	0.0	0.1	-0.5	0.0	0.0	0.1	0.0	0.0	0.1
0.5	0.0	0.2	0.1	0.1	0.0	-0.1	0.0	0.0	0.1	-0.1	-0.1	0.0
0.6	-0.2	0.0	-0.2	0.4	0.0	-0.1	-0.2	0.1	0.1	0.1	0.0	-0.1
0.7	-0.1	0.2	-0.3	0.3	-0.1	0.1	-0.2	0.1	0.2	-0.1	0.0	-0.1
0.8	-0.1	0.0	-0.2	0.0	0.0	0.1	-0.1	0.0	0.0	-0.1	0.0	0.0
0.9	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.1
Long Term												
Full Simulation Period ^b	-0.1	0.2	0.0	0.1	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	-0.1
Water Year Types ^c												
Wet (32%)	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.2	0.3	0.1	0.2	-0.1	-0.2	-0.1	0.0	0.2	-0.1	0.1	0.0
Below Normal (13%)	-0.2	0.1	0.0	-0.2	0.0	0.0	-0.2	0.0	0.0	0.3	0.0	-0.1
Dry (24%)	-0.1	0.0	-0.1	0.1	0.0	-0.3	0.0	-0.1	0.1	0.0	0.0	0.0
Critical (15%)	-0.6	0.8	0.1	0.3	0.3	-0.1	0.0	0.0	-0.1	-0.4	-0.1	-0.6

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-1-6. Trinity River below Lewiston Dam, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	55	53	52	50	50	53	52	51	55	54	55	55
20%	55	53	51	49	49	52	52	50	52	53	53	53
30%	54	52	50	48	49	51	52	48	52	52	52	53
40%	53	51	49	48	48	50	52	47	51	52	52	52
50%	52	51	49	48	47	50	51	46	50	51	51	52
60%	51	50	48	47	47	49	51	46	49	51	51	51
70%	51	50	47	46	46	48	50	45	49	51	51	50
80%	50	49	46	45	45	47	49	45	47	50	50	50
90%	49	48	46	44	44	46	48	45	46	50	50	49
Long Term												
Full Simulation Period ^b	52	51	49	47	48	50	51	47	50	52	52	52
Water Year Types ^c												
Wet (32%)	49	48	45	46	46	48	49	46	48	51	51	51
Above Normal (16%)	53	51	48	46	47	49	50	45	48	50	50	50
Below Normal (13%)	52	50	48	48	47	50	51	47	50	51	52	52
Dry (24%)	52	51	50	48	49	51	52	48	52	52	52	53
Critical (15%)	55	52	51	49	50	52	52	50	55	55	55	55

Alternative 5

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	56	54	52	50	50	53	52	51	55	54	55	55
20%	55	53	51	49	50	52	52	50	52	53	53	54
30%	54	52	50	49	49	51	52	48	52	52	52	53
40%	53	51	50	48	48	50	51	47	51	52	52	52
50%	52	51	49	48	47	50	51	46	50	52	51	51
60%	51	50	49	48	47	49	50	46	49	51	51	51
70%	50	50	48	47	46	49	50	45	48	51	51	50
80%	50	49	47	45	46	48	49	45	47	50	50	49
90%	49	49	46	44	45	46	48	45	46	50	50	49
Long Term												
Full Simulation Period ^b	52	51	49	48	48	50	51	47	50	52	52	52
Water Year Types ^c												
Wet (32%)	49	48	46	46	46	48	49	46	48	51	51	50
Above Normal (16%)	53	51	49	47	46	49	50	45	48	51	50	50
Below Normal (13%)	51	51	50	48	48	50	51	47	50	51	52	52
Dry (24%)	52	51	50	48	49	51	52	48	52	52	53	53
Critical (15%)	56	50	51	49	49	51	52	50	56	55	56	54


Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.3	0.6	0.0	-0.1	0.2	0.0	0.0	0.2	0.2	0.3	0.3	-0.1
0.2	0.2	0.1	0.2	0.2	0.1	-0.3	0.0	0.0	-0.1	0.1	0.5	0.3
0.3	0.6	-0.2	0.3	0.6	-0.1	-0.2	0.0	0.0	-0.2	0.2	0.3	0.2
0.4	0.5	0.0	0.7	0.2	0.1	-0.4	-0.1	-0.1	0.0	0.1	0.3	-0.1
0.5	0.0	0.0	0.9	0.2	0.0	-0.1	0.0	0.0	-0.2	0.2	0.1	-0.2
0.6	-0.5	-0.2	0.6	0.9	0.1	0.0	-0.3	0.1	-0.2	0.2	0.1	-0.5
0.7	-0.2	0.0	0.5	0.5	0.0	0.4	0.0	0.0	-0.1	0.2	0.2	-0.3
0.8	-0.3	0.0	0.6	0.1	0.1	0.4	0.2	-0.1	0.0	0.1	0.1	-0.3
0.9	0.1	0.6	0.3	0.1	0.1	0.0	-0.2	0.0	-0.1	0.0	0.1	0.0
Long Term												
Full Simulation Period ^b	0.2	-0.1	0.4	0.3	0.1	-0.1	0.0	0.0	0.0	0.2	0.2	-0.2
Water Year Types ^c												
Wet (32%)	0.0	0.1	0.4	0.2	0.2	0.1	-0.1	0.0	0.0	0.0	0.1	-0.7
Above Normal (16%)	0.6	0.8	0.5	1.0	-0.1	-0.1	-0.1	-0.1	0.0	0.2	0.3	0.2
Below Normal (13%)	-0.3	0.8	1.5	0.5	0.3	-0.1	0.0	0.0	-0.1	0.3	0.2	0.2
Dry (24%)	0.3	0.0	0.2	0.2	0.1	-0.3	0.1	0.0	-0.2	0.2	0.1	0.2
Critical (15%)	0.5	-2.2	-0.3	0.0	-0.3	-0.1	-0.1	0.2	0.5	0.5	0.6	-0.7

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
b Based on the 82-year simulation period.
c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


B.2. Clear Creek below Whiskeytown Temperature

Figure B-2-1. Clear Creek below Whiskeytown, October

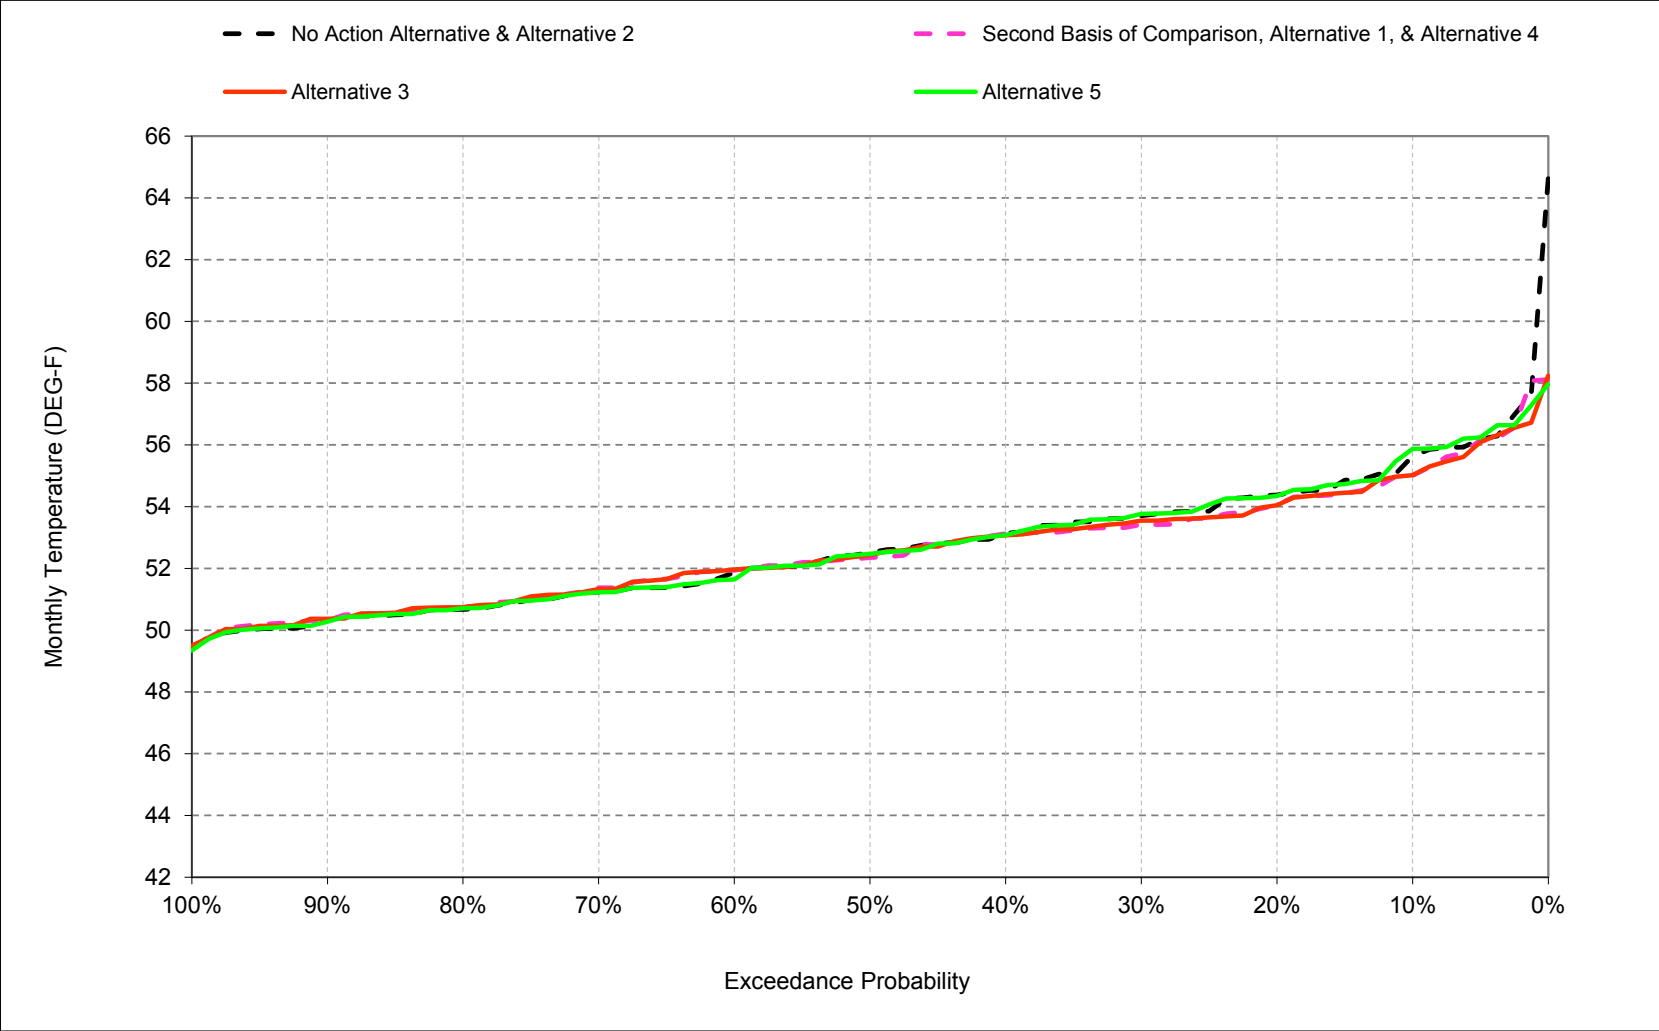


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-2-2. Clear Creek below Whiskeytown, November

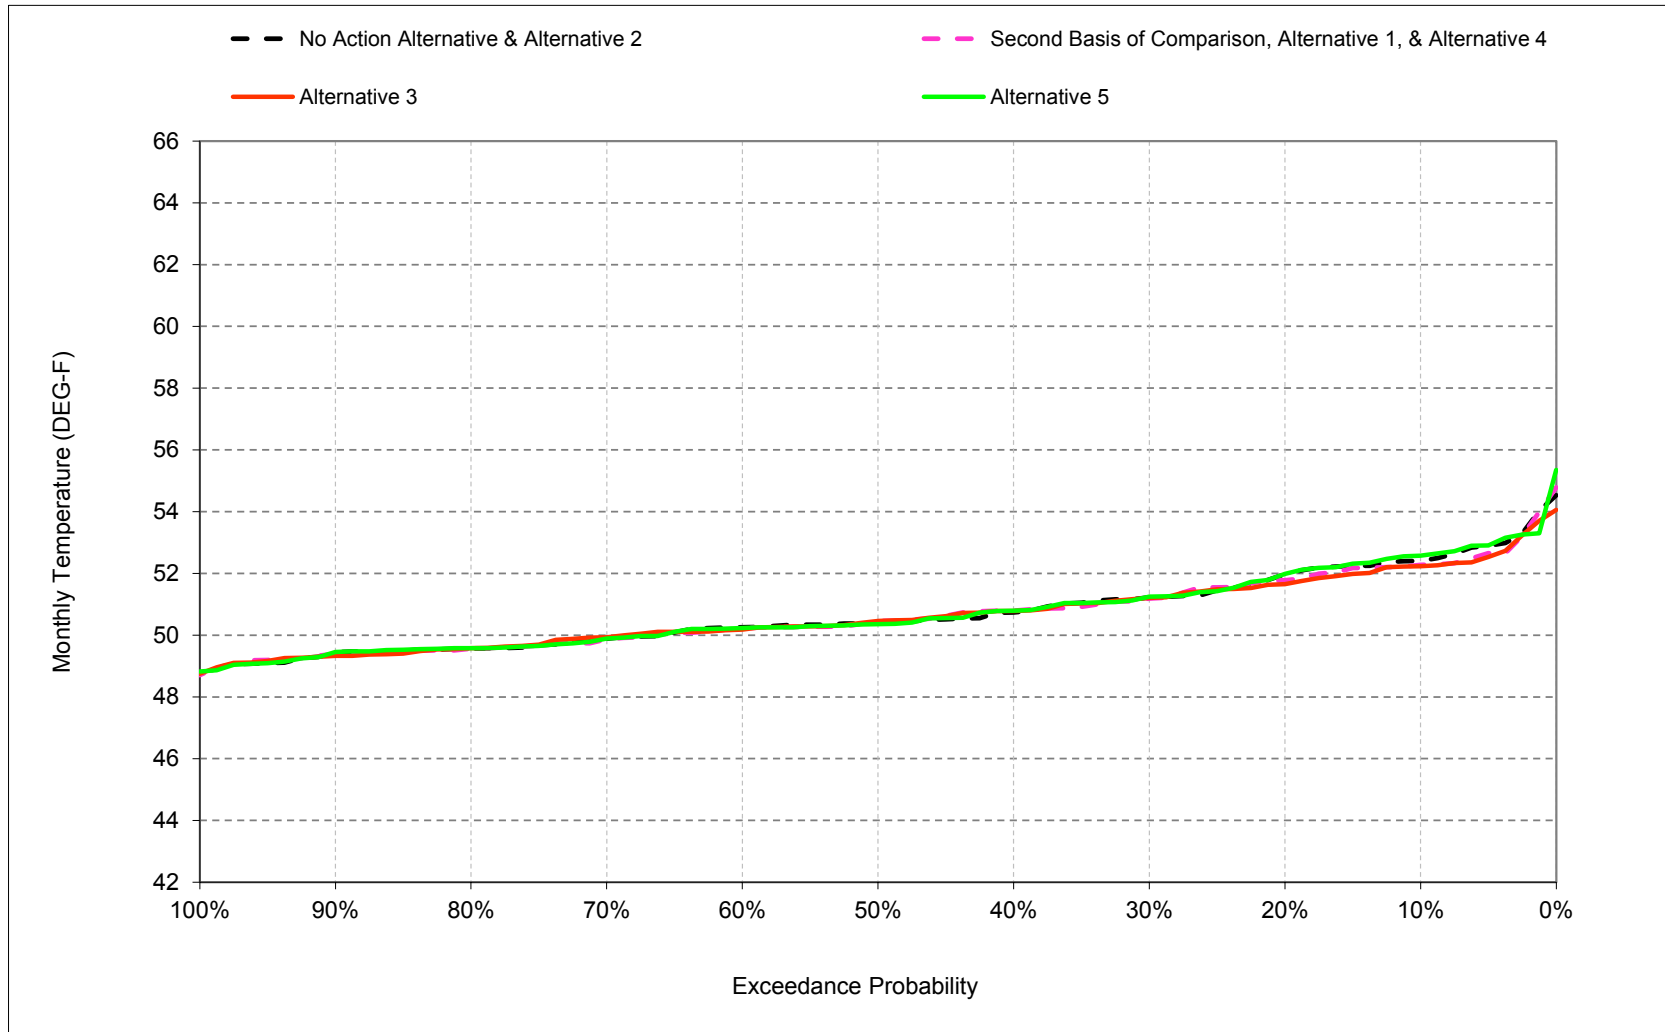


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-2-3. Clear Creek below Whiskeytown, December

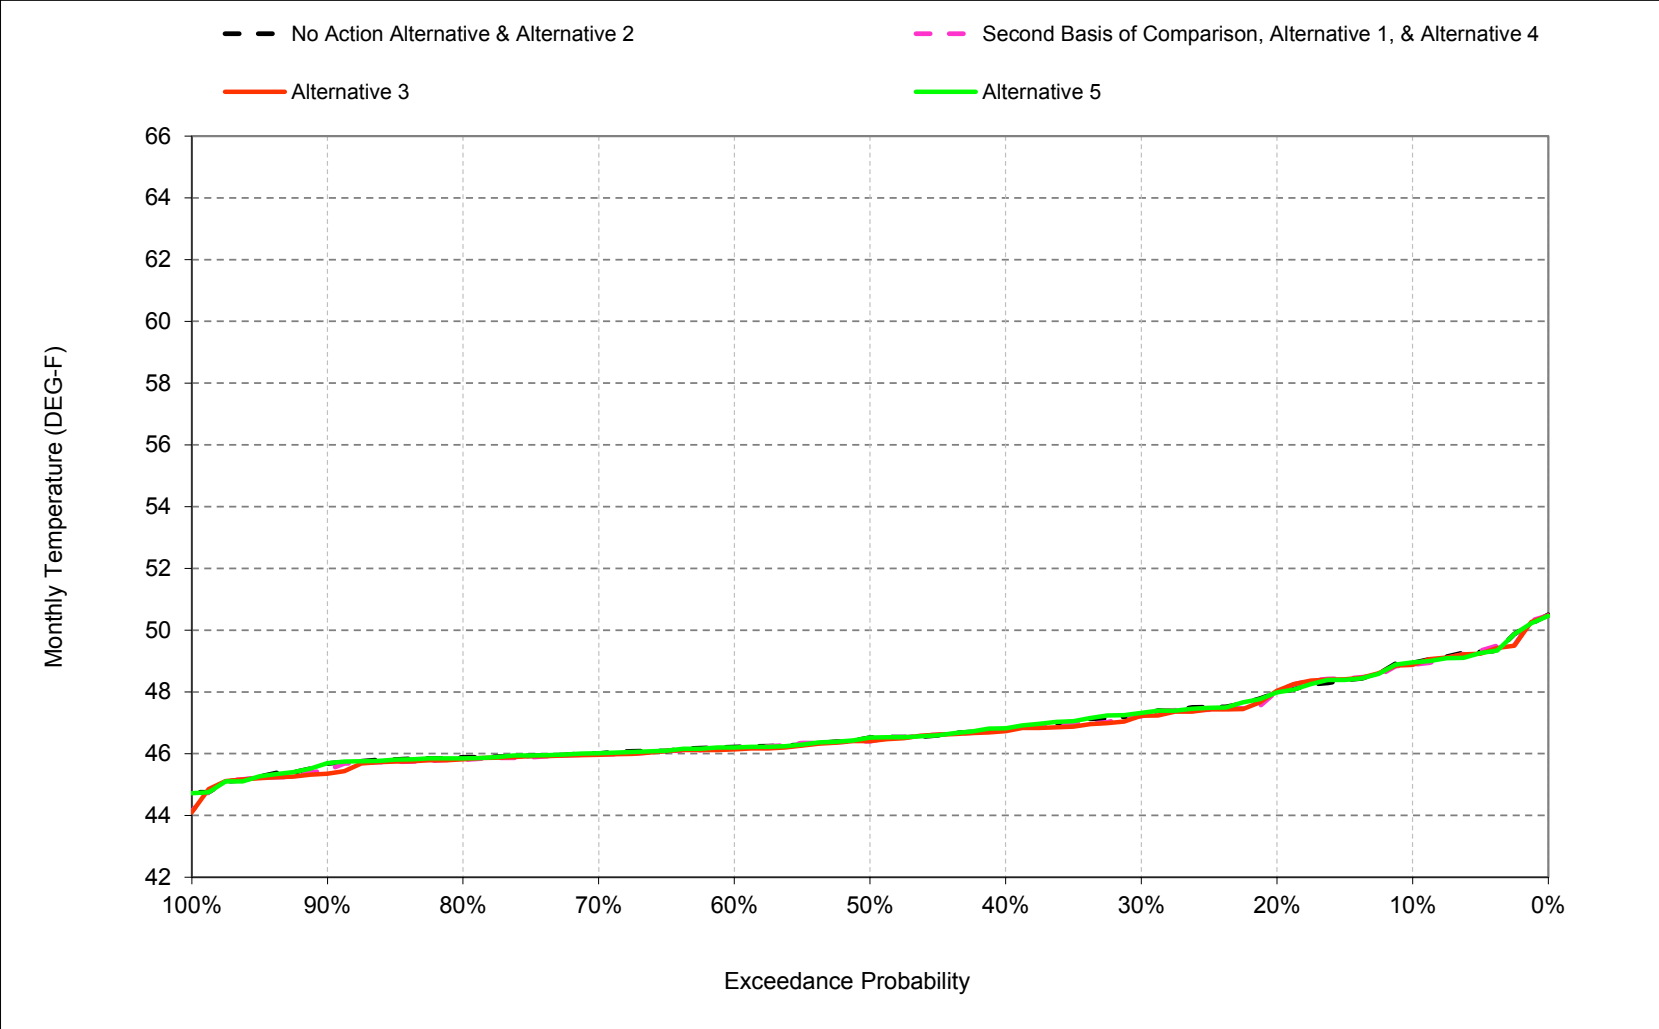


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-2-4. Clear Creek below Whiskeytown, January

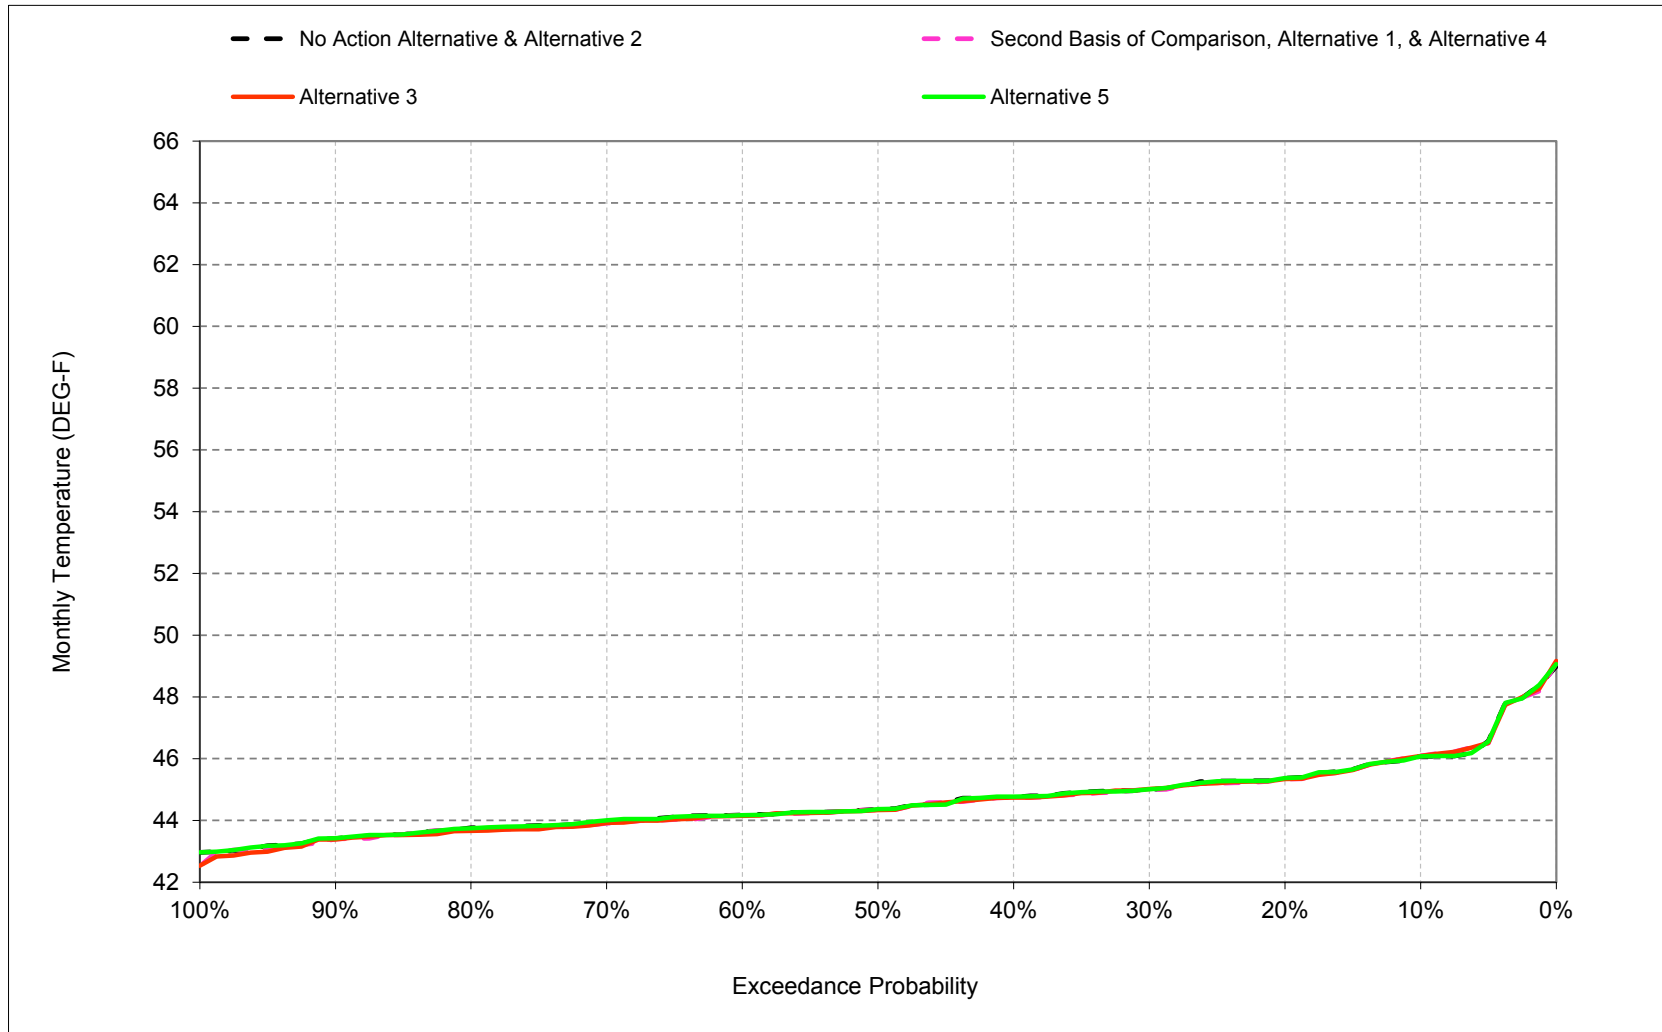


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-2-5. Clear Creek below Whiskeytown, February

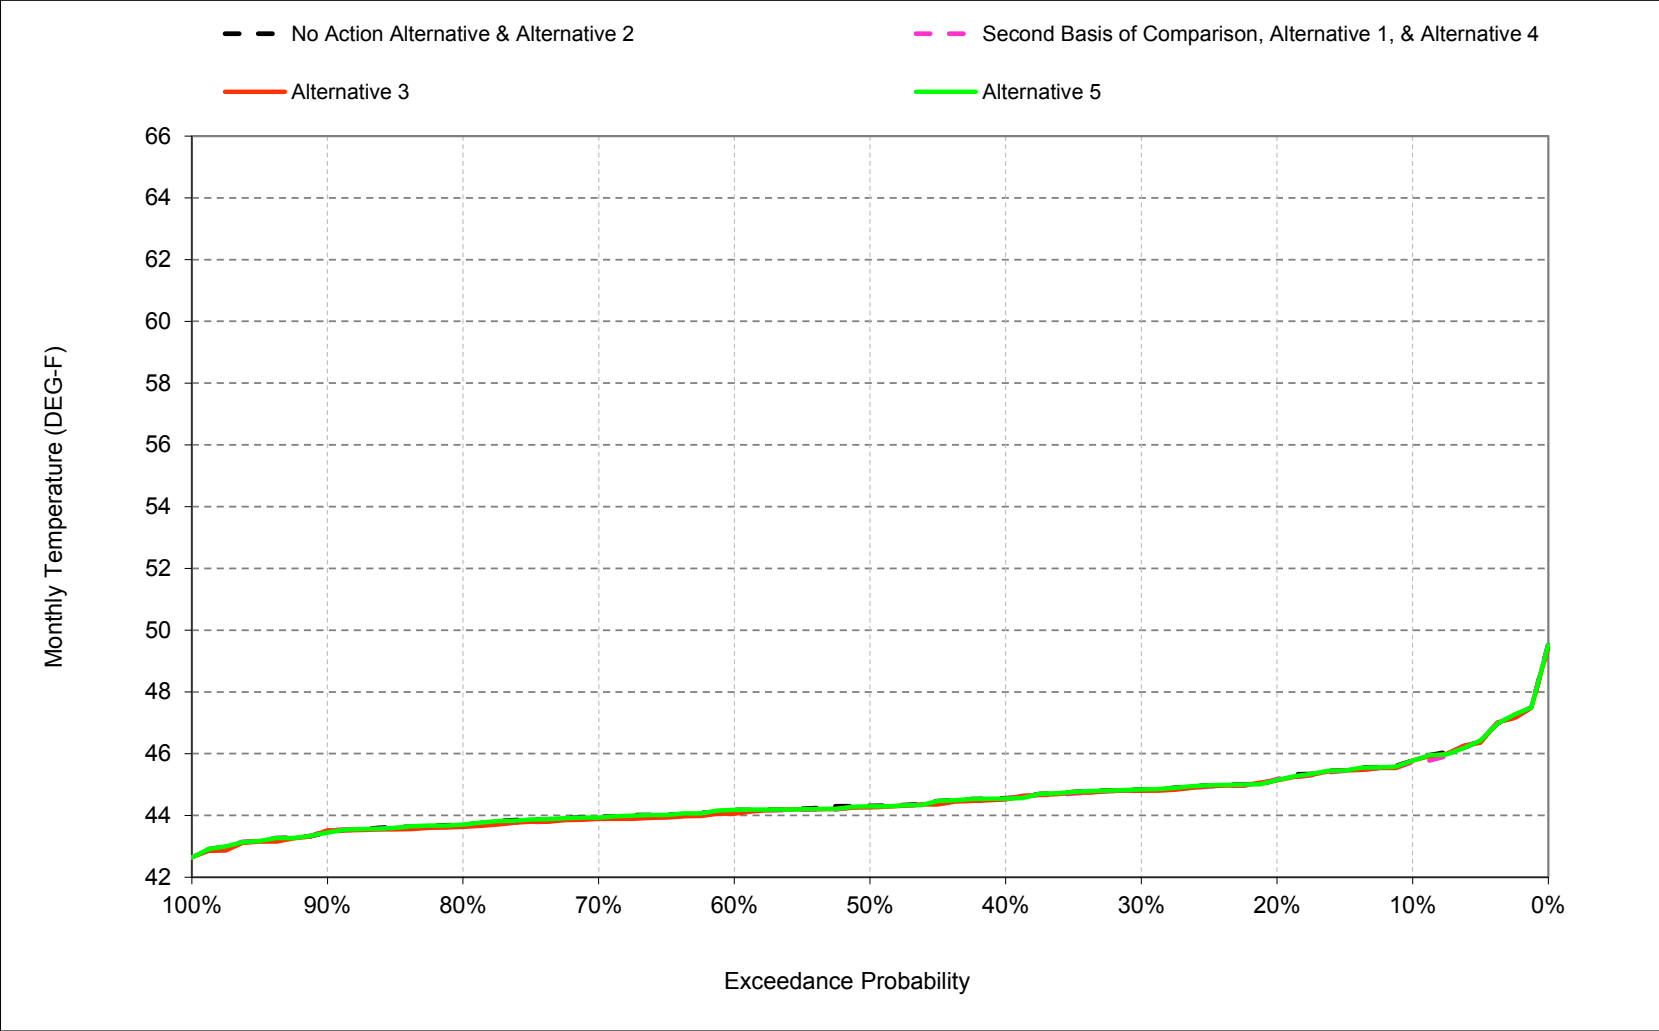


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-2-6. Clear Creek below Whiskeytown, March

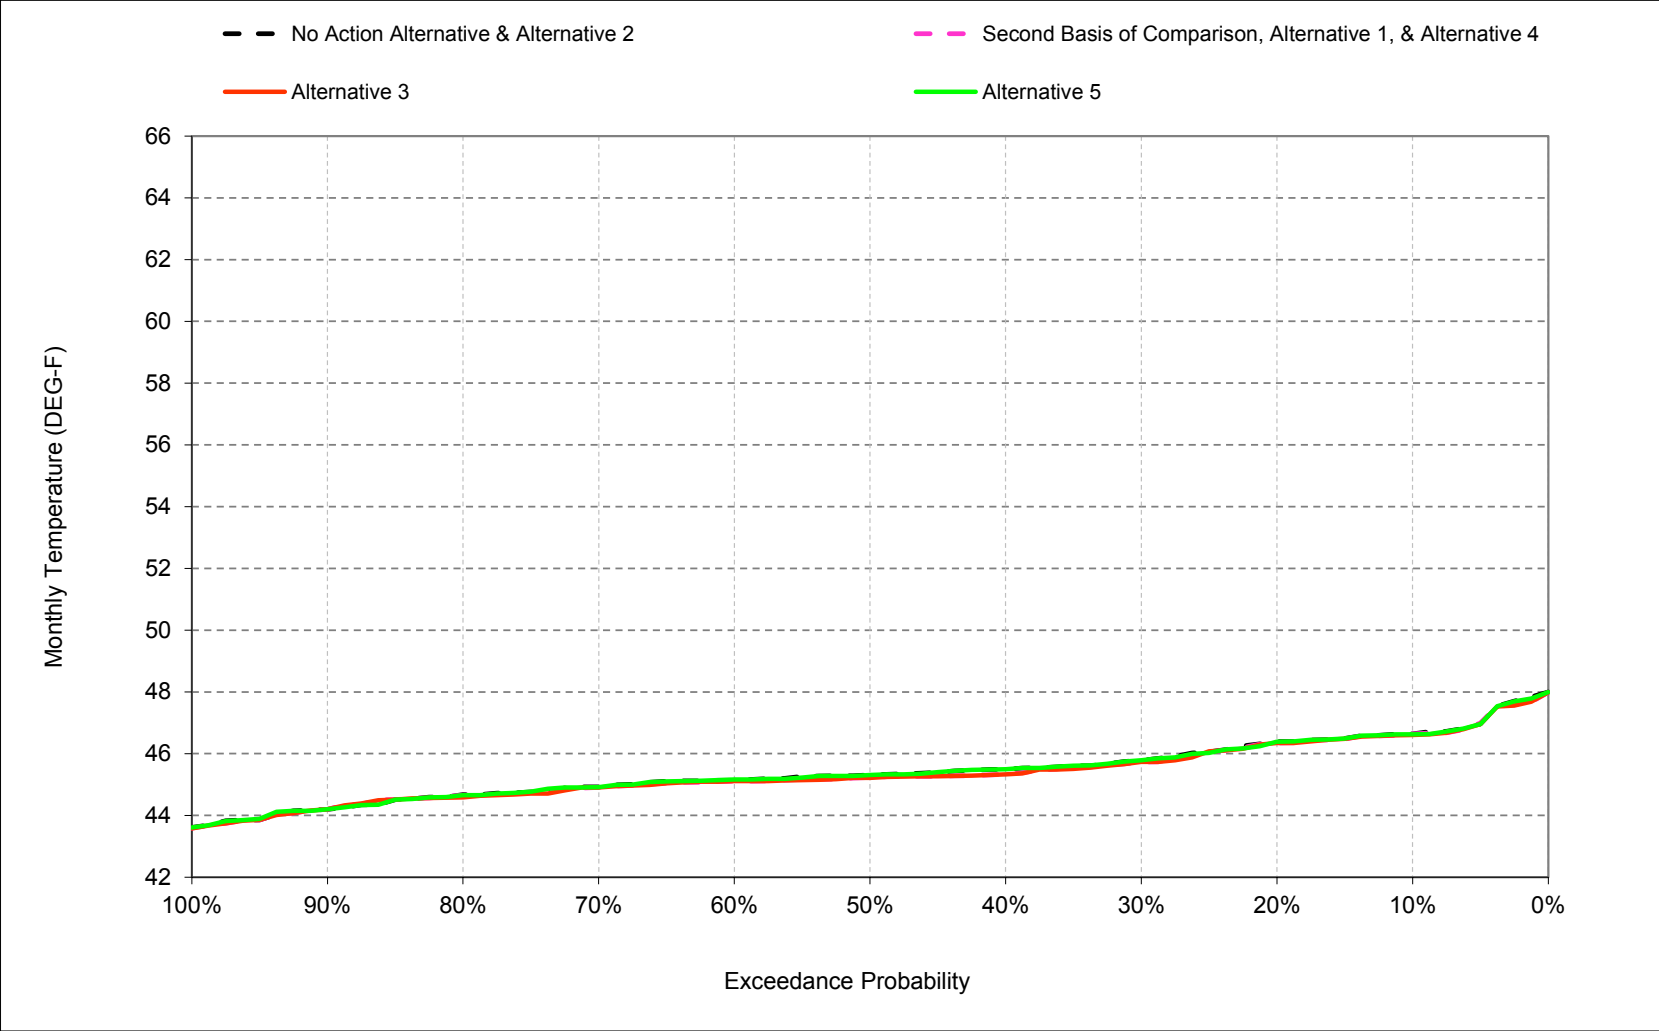


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-2-7. Clear Creek below Whiskeytown, April

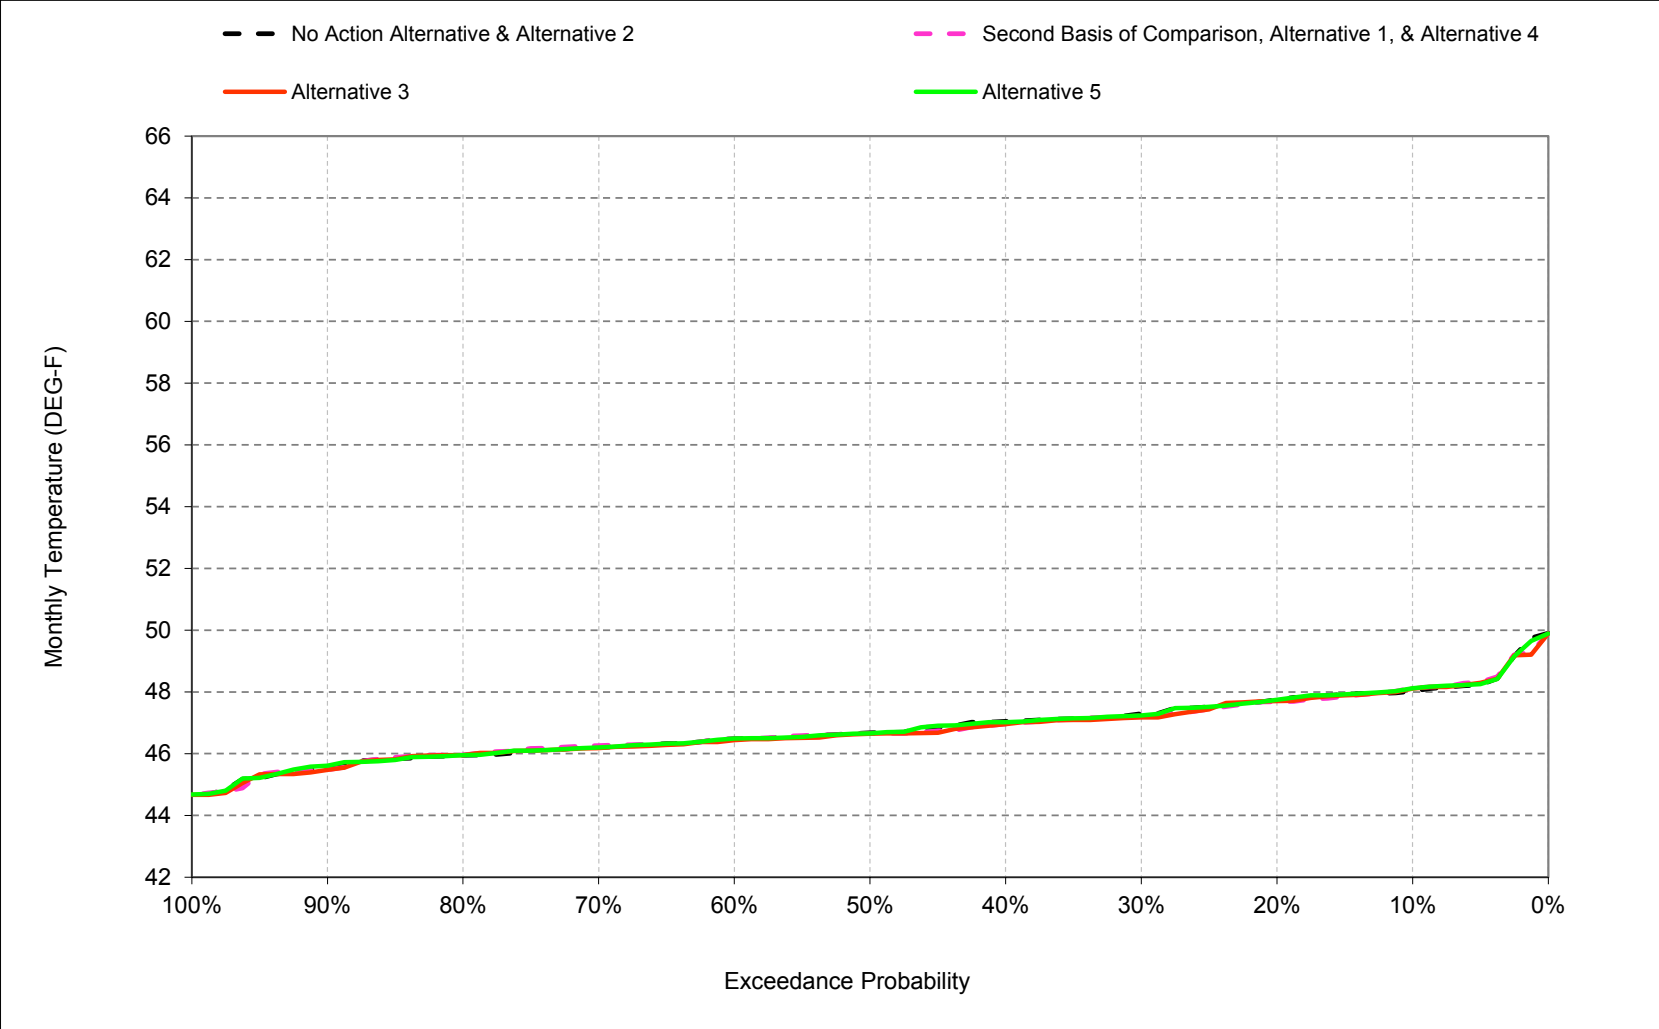


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-2-8. Clear Creek below Whiskeytown, May

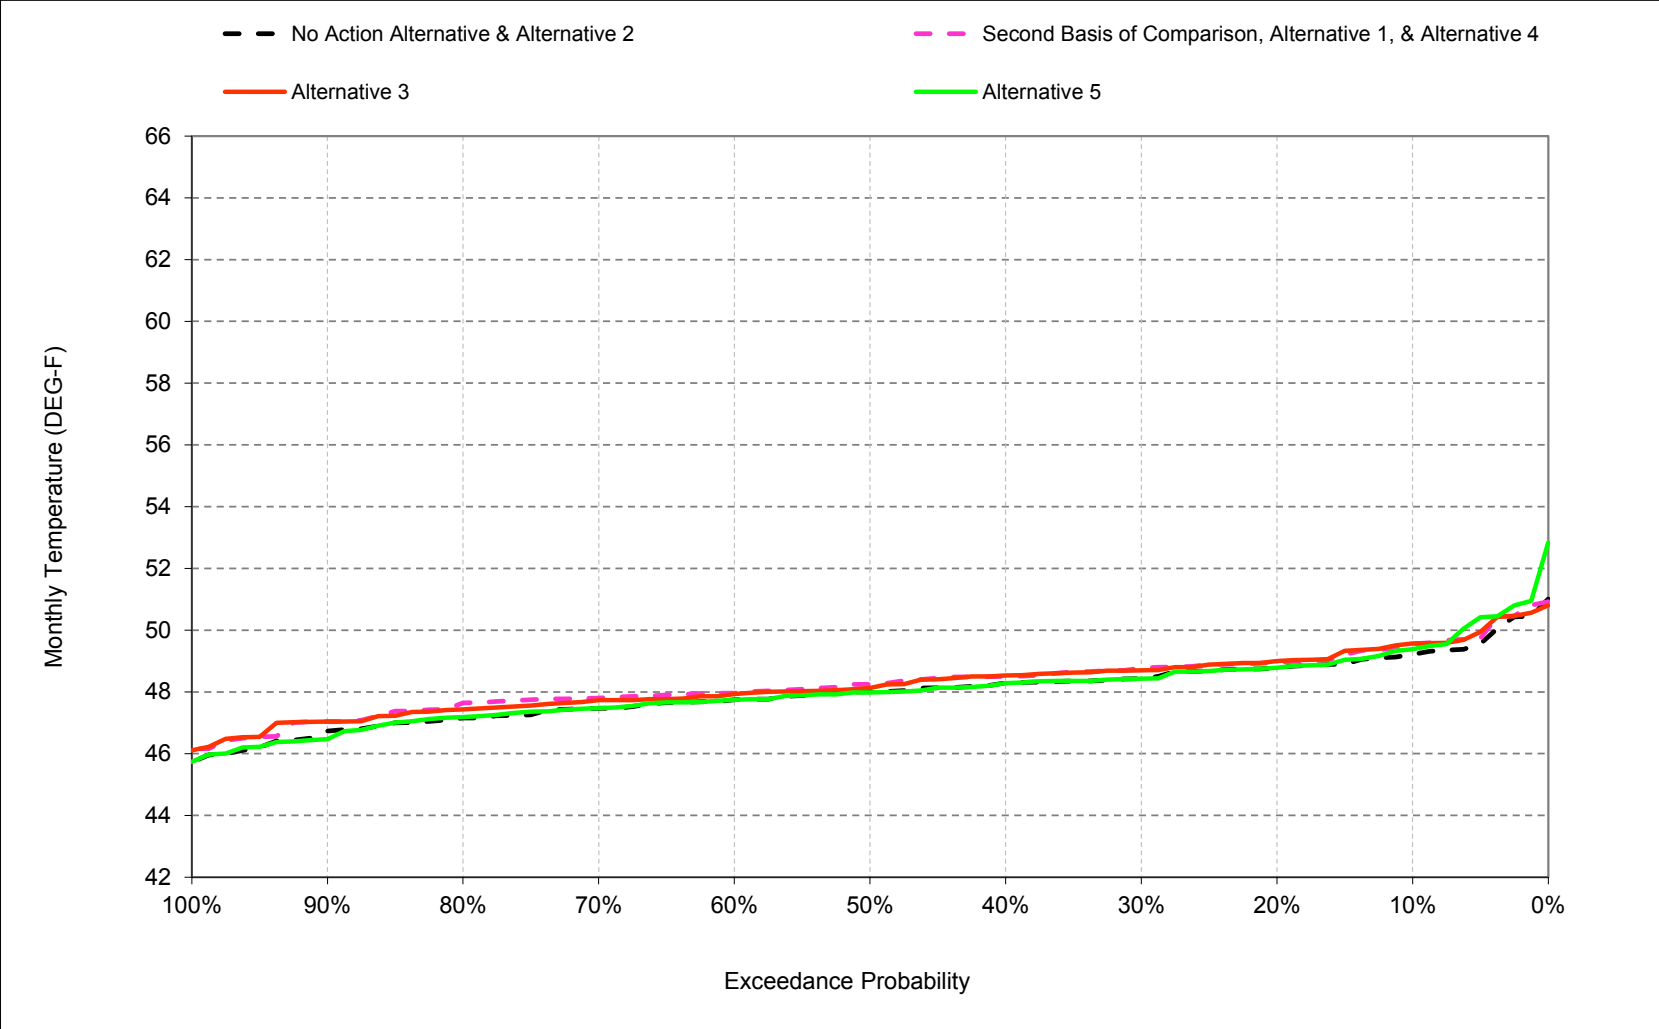


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-2-9. Clear Creek below Whiskeytown, June

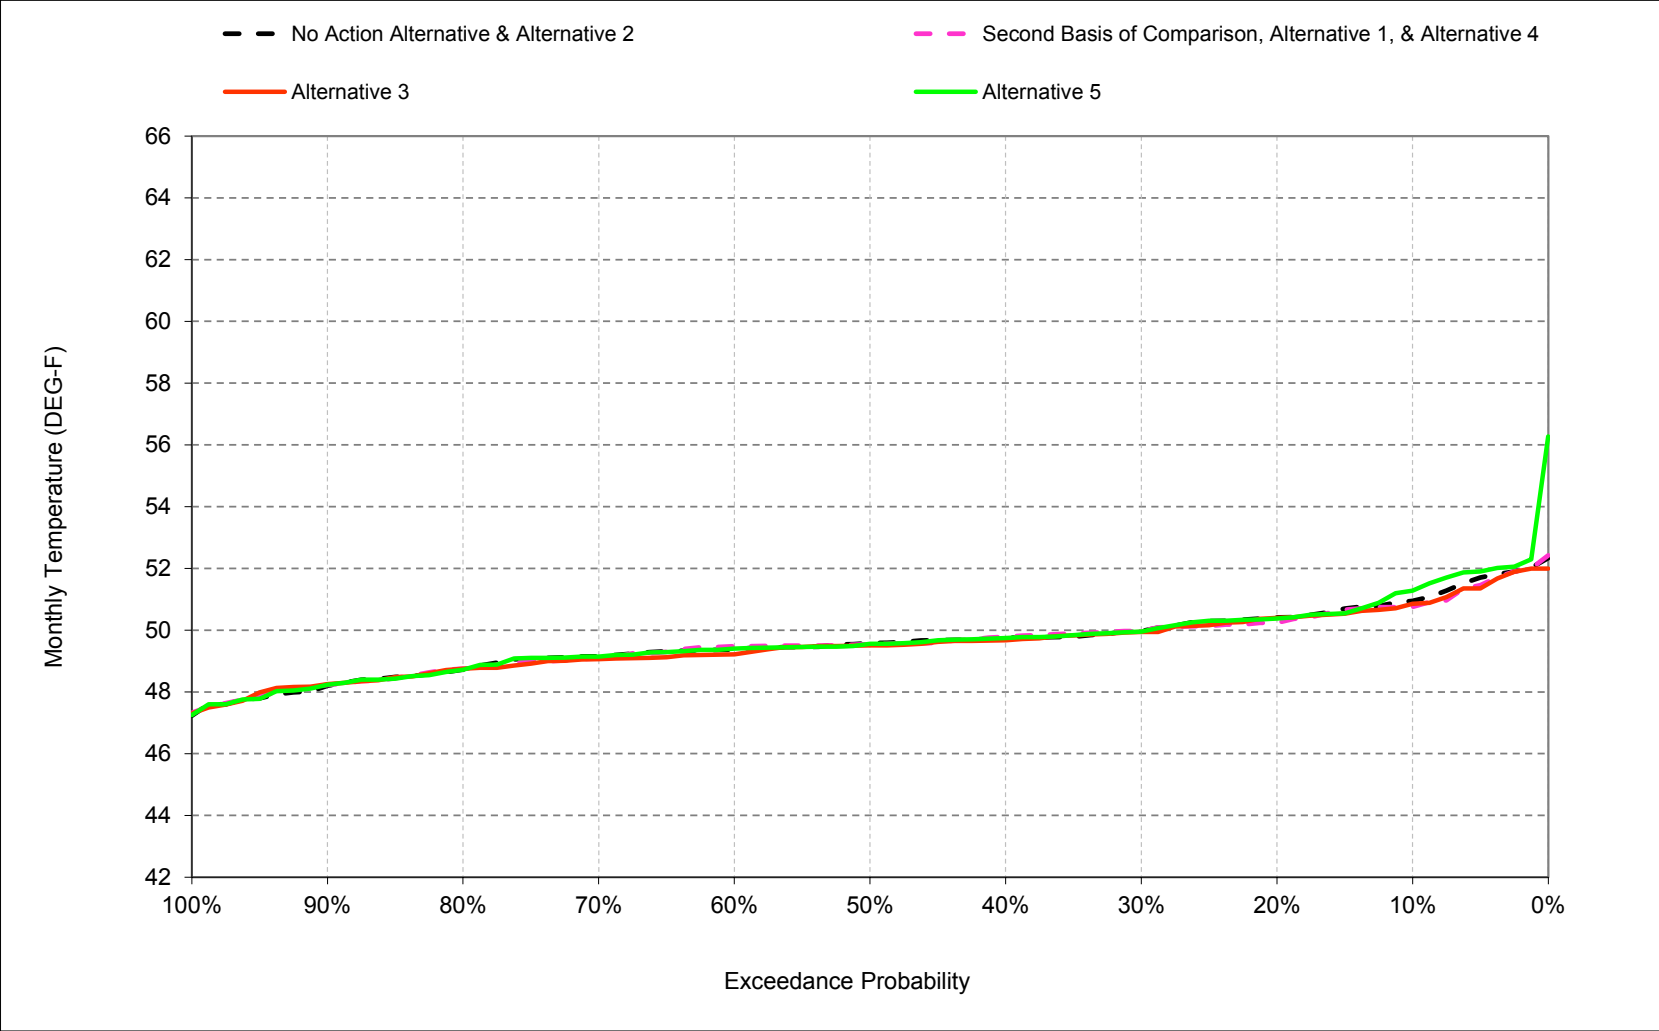


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-2-10. Clear Creek below Whiskeytown, July

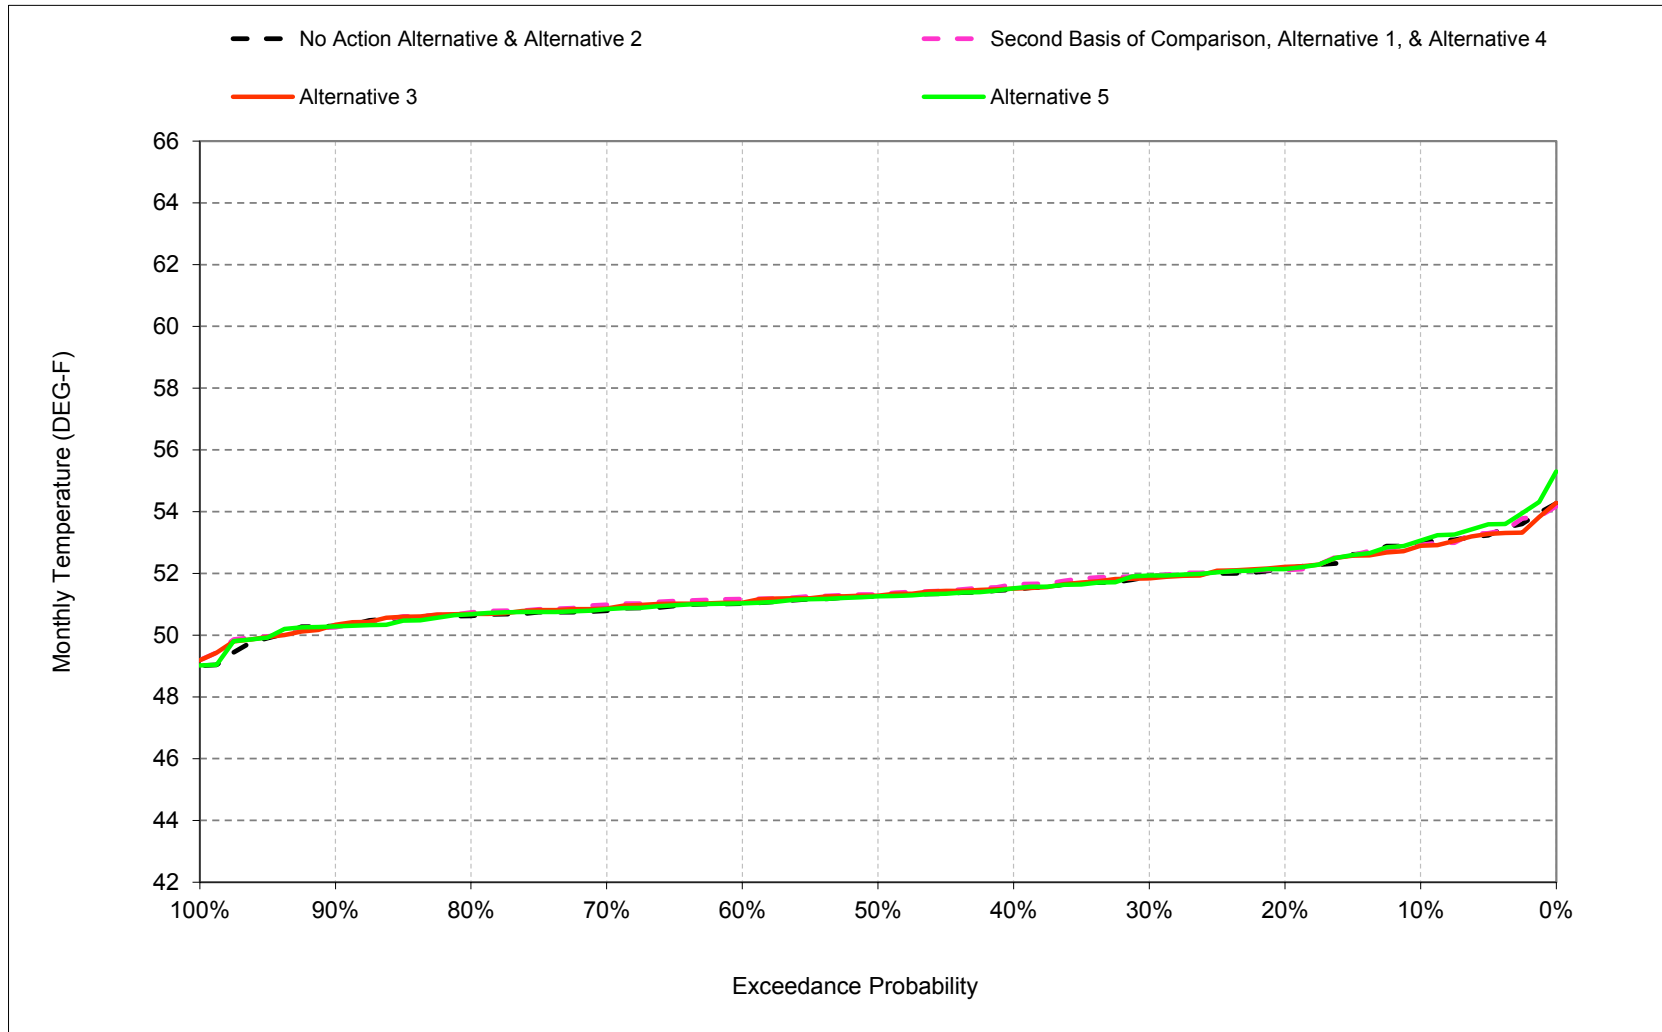


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-2-11. Clear Creek below Whiskeytown, August

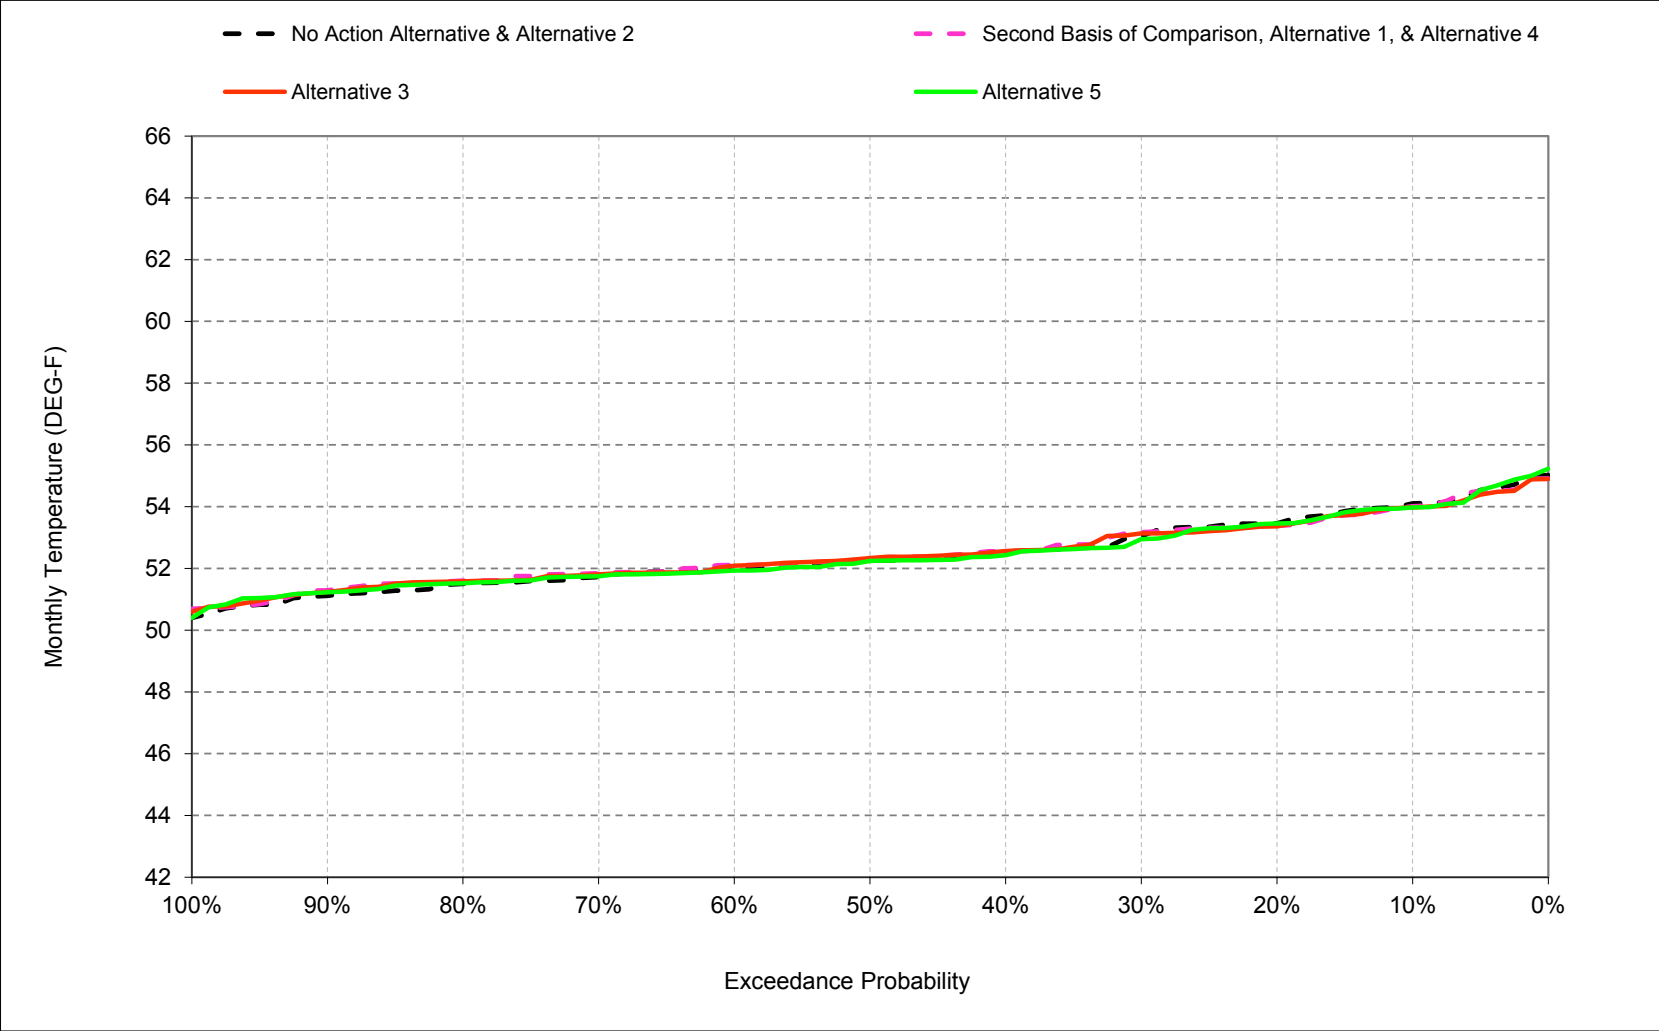

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-2-12. Clear Creek below Whiskeytown, September

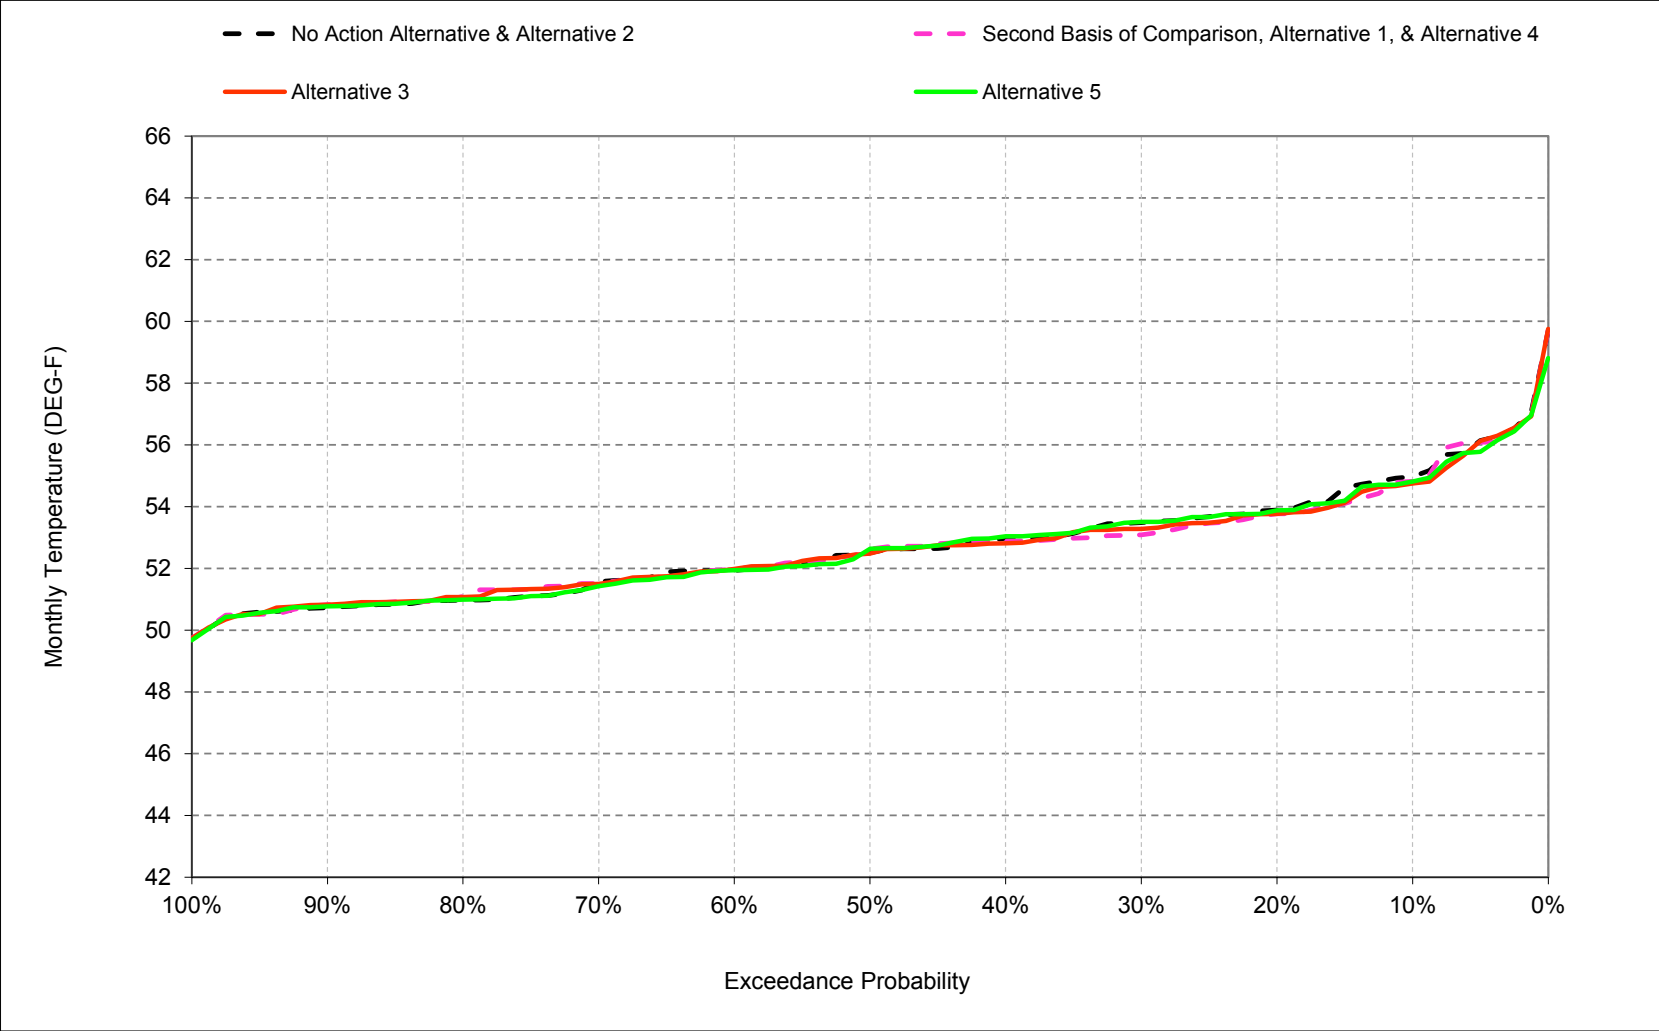

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-2-1. Clear Creek below Whiskeytown, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	56	52	49	46	46	47	48	49	51	53	54	55
20%	54	52	48	45	45	46	48	49	50	52	53	54
30%	54	51	47	45	45	46	47	48	50	52	53	53
40%	53	51	47	45	45	45	47	48	50	51	53	53
50%	53	50	47	44	44	45	47	48	50	51	52	52
60%	52	50	46	44	44	45	46	48	49	51	52	52
70%	51	50	46	44	44	45	46	47	49	51	52	51
80%	51	50	46	44	44	45	46	47	49	51	51	51
90%	50	49	46	43	43	44	45	47	48	50	51	51
Long Term												
Full Simulation Period ^b	53	51	47	45	45	45	47	48	50	51	52	53
Water Year Types ^c												
Wet (32%)	50	48	45	44	44	45	46	48	49	51	52	51
Above Normal (16%)	53	51	47	44	44	45	46	48	49	51	52	52
Below Normal (13%)	52	50	47	44	44	45	47	48	49	51	52	53
Dry (24%)	53	51	47	45	45	46	47	48	50	52	53	53
Critical (15%)	55	52	48	46	46	46	48	49	50	52	54	56

Alternative 1												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	55	52	49	46	46	47	48	50	51	53	54	55
20%	54	52	48	45	45	46	48	49	50	52	53	54
30%	53	51	47	45	45	46	47	49	50	52	53	53
40%	53	51	47	45	45	45	47	48	50	52	53	53
50%	52	50	46	44	44	45	47	48	50	51	52	53
60%	52	50	46	44	44	45	46	48	49	51	52	52
70%	51	50	46	44	44	45	46	48	49	51	52	52
80%	51	50	46	44	44	45	46	47	49	51	52	51
90%	50	49	45	43	43	44	45	47	48	50	51	51
Long Term												
Full Simulation Period ^b	53	51	47	45	44	45	47	48	50	51	52	53
Water Year Types ^c												
Wet (32%)	50	48	45	44	44	45	46	48	49	51	52	51
Above Normal (16%)	53	51	47	44	44	45	46	48	49	51	52	51
Below Normal (13%)	52	50	46	44	44	45	47	48	49	52	52	53
Dry (24%)	53	51	47	45	45	46	47	48	50	52	53	53
Critical (15%)	55	52	48	46	45	46	48	49	50	52	54	56

Alternative 1 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.6	-0.1	-0.1	0.0	0.0	0.0	0.1	0.3	-0.2	-0.1	-0.1	-0.1
0.2	-0.3	-0.2	0.0	0.0	0.0	0.0	-0.1	0.2	-0.2	0.0	-0.1	-0.1
0.3	-0.3	0.0	0.0	0.0	0.0	-0.1	-0.1	0.3	0.0	0.0	0.1	-0.4
0.4	0.0	0.1	0.0	0.0	0.0	-0.2	-0.1	0.2	0.0	0.1	0.0	-0.1
0.5	-0.2	0.1	-0.1	0.0	0.0	-0.1	0.0	0.2	0.0	0.1	0.0	0.0
0.6	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.1	0.1	0.1	0.0
0.7	0.1	0.0	0.0	0.0	-0.1	0.0	0.1	0.3	-0.1	0.2	0.1	0.1
0.8	0.1	0.0	-0.1	0.0	0.0	0.0	0.0	0.4	0.1	0.1	0.1	0.2
0.9	0.0	-0.1	-0.2	-0.1	0.0	0.0	0.0	0.5	0.1	-0.1	0.2	0.1
Long Term												
Full Simulation Period ^b	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.3	0.0	0.1	0.1	0.0
Water Year Types ^c												
Wet (32%)	0.1	-0.1	0.0	0.0	0.0	-0.1	0.0	0.3	0.0	0.1	0.1	0.1
Above Normal (16%)	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.4	0.0	0.0	0.0	-0.1
Below Normal (13%)	-0.1	0.0	-0.2	0.0	0.0	-0.1	-0.1	0.4	0.2	0.2	0.1	0.0
Dry (24%)	-0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.2	-0.1	0.0	0.0	-0.2
Critical (15%)	-0.3	-0.1	-0.1	0.0	-0.1	-0.1	-0.1	0.1	0.0	0.1	0.1	-0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-2-2. Clear Creek below Whiskeytown, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	56	52	49	46	46	47	48	49	51	53	54	55
20%	54	52	48	45	45	46	48	49	50	52	53	54
30%	54	51	47	45	45	46	47	48	50	52	53	53
40%	53	51	47	45	45	45	47	48	50	51	53	53
50%	53	50	47	44	44	45	47	48	50	51	52	52
60%	52	50	46	44	44	45	46	48	49	51	52	52
70%	51	50	46	44	44	45	46	47	49	51	52	51
80%	51	50	46	44	44	45	46	47	49	51	51	51
90%	50	49	46	43	43	44	45	47	48	50	51	51
Long Term												
Full Simulation Period ^b	53	51	47	45	45	45	47	48	50	51	52	53
Water Year Types ^c												
Wet (32%)	50	48	45	44	44	45	46	48	49	51	52	51
Above Normal (16%)	53	51	47	44	44	45	46	48	49	51	52	52
Below Normal (13%)	52	50	47	44	44	45	47	48	49	51	52	53
Dry (24%)	53	51	47	45	45	46	47	48	50	52	53	53
Critical (15%)	55	52	48	46	46	46	48	49	50	52	54	56

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	55	52	49	46	46	47	48	50	51	53	54	55
20%	54	52	48	45	45	46	48	49	50	52	53	54
30%	54	51	47	45	45	46	47	49	50	52	53	53
40%	53	51	47	45	45	45	47	49	50	51	53	53
50%	52	50	46	44	44	45	47	48	49	51	52	52
60%	52	50	46	44	44	45	46	48	49	51	52	52
70%	51	50	46	44	44	45	46	48	49	51	52	51
80%	51	50	46	44	44	45	46	47	49	51	52	51
90%	50	49	45	43	43	44	45	47	48	50	51	51
Long Term												
Full Simulation Period ^b	53	51	47	45	44	45	47	48	50	51	52	53
Water Year Types ^c												
Wet (32%)	50	48	45	44	44	45	46	48	49	51	52	51
Above Normal (16%)	53	51	47	44	44	45	46	48	49	51	52	51
Below Normal (13%)	52	50	46	44	44	45	47	48	49	52	52	53
Dry (24%)	53	51	47	45	45	46	47	48	49	52	53	53
Critical (15%)	54	52	48	46	45	46	48	49	50	52	54	56

Alternative 3 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.6	-0.2	-0.1	0.0	0.0	0.0	0.1	0.4	-0.1	-0.1	-0.1	-0.2
0.2	-0.3	-0.3	0.1	0.0	0.0	0.0	0.0	0.2	0.0	0.1	-0.1	-0.1
0.3	-0.2	0.0	0.0	0.0	0.0	-0.1	-0.1	0.3	0.0	0.0	0.1	-0.2
0.4	-0.1	0.1	-0.1	0.0	0.0	-0.2	-0.1	0.3	-0.1	0.0	0.0	-0.1
0.5	-0.1	0.1	-0.1	0.0	0.0	-0.1	0.0	0.1	-0.1	0.0	0.1	0.0
0.6	0.1	-0.1	-0.1	0.0	-0.1	0.0	-0.1	0.2	-0.2	0.0	0.1	0.0
0.7	0.1	0.0	0.0	0.0	-0.1	0.0	0.0	0.2	-0.1	0.1	0.1	0.0
0.8	0.1	0.0	-0.1	-0.1	-0.1	0.0	0.0	0.3	0.1	0.1	0.1	0.1
0.9	0.0	-0.1	-0.3	0.0	0.0	0.0	-0.1	0.5	0.2	-0.1	0.1	0.1
Long Term												
Full Simulation Period ^b	-0.1	-0.1	-0.1	0.0	0.0	-0.1	0.0	0.3	-0.1	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.1	-0.1	0.0	-0.1	0.0	-0.1	0.0	0.3	0.0	0.1	0.1	0.2
Above Normal (16%)	-0.1	0.0	-0.1	-0.1	0.0	0.0	0.0	0.3	-0.1	0.0	0.0	-0.1
Below Normal (13%)	0.0	0.0	-0.2	0.0	-0.1	-0.1	-0.1	0.4	0.1	0.1	0.1	-0.1
Dry (24%)	-0.4	0.0	0.0	0.0	0.0	0.0	-0.1	0.2	-0.2	-0.1	-0.1	-0.2
Critical (15%)	-0.4	-0.3	-0.2	-0.1	-0.1	-0.1	-0.1	0.0	-0.1	0.0	0.1	-0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-2-3. Clear Creek below Whiskeytown, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	56	52	49	46	46	47	48	49	51	53	54	55
20%	54	52	48	45	45	46	48	49	50	52	53	54
30%	54	51	47	45	45	46	47	48	50	52	53	53
40%	53	51	47	45	45	45	47	48	50	51	53	53
50%	53	50	47	44	44	45	47	48	50	51	52	52
60%	52	50	46	44	44	45	46	48	49	51	52	52
70%	51	50	46	44	44	45	46	47	49	51	52	51
80%	51	50	46	44	44	45	46	47	49	51	51	51
90%	50	49	46	43	43	44	45	47	48	50	51	51
Long Term												
Full Simulation Period ^b	53	51	47	45	45	45	47	48	50	51	52	53
Water Year Types ^c												
Wet (32%)	50	48	45	44	44	45	46	48	49	51	52	51
Above Normal (16%)	53	51	47	44	44	45	46	48	49	51	52	52
Below Normal (13%)	52	50	47	44	44	45	47	48	49	51	52	53
Dry (24%)	53	51	47	45	45	46	47	48	50	52	53	53
Critical (15%)	55	52	48	46	46	46	48	49	50	52	54	56

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	56	53	49	46	46	47	48	49	51	53	54	55
20%	54	52	48	45	45	46	48	49	50	52	53	54
30%	54	51	47	45	45	46	47	48	50	52	53	53
40%	53	51	47	45	45	45	47	48	50	51	52	53
50%	52	50	47	44	44	45	47	48	50	51	52	52
60%	52	50	46	44	44	45	46	48	49	51	52	52
70%	51	50	46	44	44	45	46	47	49	51	52	51
80%	51	50	46	44	44	45	46	47	49	51	52	51
90%	50	49	46	43	43	44	46	46	48	50	51	51
Long Term												
Full Simulation Period ^b	53	51	47	45	45	45	47	48	50	51	52	53
Water Year Types ^c												
Wet (32%)	50	48	45	44	44	45	46	48	49	51	52	51
Above Normal (16%)	53	51	47	44	44	45	46	48	49	51	52	51
Below Normal (13%)	52	50	47	44	44	45	47	48	49	52	52	53
Dry (24%)	53	51	47	45	45	46	47	48	50	52	53	53
Critical (15%)	55	52	48	46	46	46	48	49	51	52	53	56

Alternative 5 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.2	0.2	0.0	0.0	0.0	0.0	0.1	0.2	0.3	0.1	-0.1	-0.2
0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
0.3	0.1	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.0
0.4	-0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.1
0.5	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0
0.6	-0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0
0.7	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
0.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0
0.9	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.1	0.0	0.1	0.0
Long Term												
Full Simulation Period ^b	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.1	0.1	0.1	0.1
Dry (24%)	-0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3	0.4	0.2	-0.2	-0.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-2-4. Clear Creek below Whiskeytown, Monthly Temperature

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	55	52	49	46	46	47	48	50	51	53	54	55
20%	54	52	48	45	45	46	48	49	50	52	53	54
30%	53	51	47	45	45	46	47	49	50	52	53	53
40%	53	51	47	45	45	45	47	48	50	52	53	53
50%	52	50	46	44	44	45	47	48	50	51	52	53
60%	52	50	46	44	44	45	46	48	49	51	52	52
70%	51	50	46	44	44	45	46	48	49	51	52	52
80%	51	50	46	44	44	45	46	47	49	51	52	51
90%	50	49	45	43	43	44	45	47	48	50	51	51
Long Term												
Full Simulation Period ^b	53	51	47	45	44	45	47	48	50	51	52	53
Water Year Types ^c												
Wet (32%)	50	48	45	44	44	45	46	48	49	51	52	51
Above Normal (16%)	53	51	47	44	44	45	46	48	49	51	52	51
Below Normal (13%)	52	50	46	44	44	45	47	48	49	52	52	53
Dry (24%)	53	51	47	45	45	46	47	48	50	52	53	53
Critical (15%)	55	52	48	46	45	46	48	49	50	52	54	56

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance ^a												
10%	56	52	49	46	46	47	48	49	51	53	54	55
20%	54	52	48	45	45	46	48	49	50	52	53	54
30%	54	51	47	45	45	46	47	48	50	52	53	53
40%	53	51	47	45	45	45	47	48	50	51	53	53
50%	53	50	47	44	44	45	47	48	50	51	52	52
60%	52	50	46	44	44	45	46	48	49	51	52	52
70%	51	50	46	44	44	45	46	47	49	51	52	51
80%	51	50	46	44	44	45	46	47	49	51	51	51
90%	50	49	46	43	43	44	45	47	48	50	51	51
Long Term												
Full Simulation Period ^b	53	51	47	45	45	45	47	48	50	51	52	53
Water Year Types ^c												
Wet (32%)	50	48	45	44	44	45	46	48	49	51	52	51
Above Normal (16%)	53	51	47	44	44	45	46	48	49	51	52	52
Below Normal (13%)	52	50	47	44	44	45	47	48	49	51	52	53
Dry (24%)	53	51	47	45	45	46	47	48	50	52	53	53
Critical (15%)	55	52	48	46	46	46	48	49	50	52	54	56

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative minus Second Basis of Comparison												
Probability of Exceedance ^a												
0.1	0.6	0.1	0.1	0.0	0.0	0.0	-0.1	-0.3	0.2	0.1	0.1	0.1
0.2	0.3	0.2	0.0	0.0	0.0	0.0	0.1	-0.2	0.2	0.0	0.1	0.1
0.3	0.3	0.0	0.0	0.0	0.0	0.1	0.1	-0.3	0.0	0.0	-0.1	0.4
0.4	0.0	-0.1	0.0	0.0	0.0	0.2	0.1	-0.2	0.0	-0.1	0.0	0.1
0.5	0.2	-0.1	0.1	0.0	0.0	0.1	0.0	-0.2	0.0	-0.1	0.0	0.0
0.6	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.2	-0.1	-0.1	-0.1	0.0
0.7	-0.1	0.0	0.0	0.0	0.1	0.0	-0.1	-0.3	0.1	-0.2	-0.1	-0.1
0.8	-0.1	0.0	0.1	0.0	0.0	0.0	0.0	-0.4	-0.1	-0.1	-0.1	-0.2
0.9	0.0	0.1	0.2	0.1	0.0	0.0	-0.5	-0.1	0.1	-0.2	-0.1	-0.1
Long Term												
Full Simulation Period ^b	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.3	0.0	-0.1	-0.1	0.0
Water Year Types ^c												
Wet (32%)	-0.1	0.1	0.0	0.0	0.0	0.1	0.0	-0.3	0.0	-0.1	-0.1	-0.1
Above Normal (16%)	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.4	0.0	0.0	0.0	0.1
Below Normal (13%)	0.1	0.0	0.2	0.0	0.0	0.1	0.1	-0.4	-0.2	-0.2	-0.1	0.0
Dry (24%)	0.4	0.0	0.0	0.0	0.0	0.0	0.0	-0.2	0.1	0.0	0.0	0.2
Critical (15%)	0.3	0.1	0.1	0.0	0.1	0.1	0.1	-0.1	0.0	-0.1	-0.1	0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-2-5. Clear Creek below Whiskeytown, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	55	52	49	46	46	47	48	50	51	53	54	55
20%	54	52	48	45	45	46	48	49	50	52	53	54
30%	53	51	47	45	45	46	47	49	50	52	53	53
40%	53	51	47	45	45	45	47	48	50	52	53	53
50%	52	50	46	44	44	45	47	48	50	51	52	53
60%	52	50	46	44	44	45	46	48	49	51	52	52
70%	51	50	46	44	44	45	46	48	49	51	52	52
80%	51	50	46	44	44	45	46	47	49	51	52	51
90%	50	49	45	43	43	44	45	47	48	50	51	51
Long Term												
Full Simulation Period ^b	53	51	47	45	44	45	47	48	50	51	52	53
Water Year Types ^c												
Wet (32%)	50	48	45	44	44	45	46	48	49	51	52	51
Above Normal (16%)	53	51	47	44	44	45	46	48	49	51	52	51
Below Normal (13%)	52	50	46	44	44	45	47	48	49	52	52	53
Dry (24%)	53	51	47	45	45	46	47	48	50	52	53	53
Critical (15%)	55	52	48	46	45	46	48	49	50	52	54	56

Alternative 3

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	55	52	49	46	46	47	48	50	51	53	54	55
20%	54	52	48	45	45	46	48	49	50	52	53	54
30%	54	51	47	45	45	46	47	49	50	52	53	53
40%	53	51	47	45	45	45	47	49	50	51	53	53
50%	52	50	46	44	44	45	47	48	49	51	52	52
60%	52	50	46	44	44	45	46	48	49	51	52	52
70%	51	50	46	44	44	45	46	48	49	51	52	51
80%	51	50	46	44	44	45	46	47	49	51	52	51
90%	50	49	45	43	43	44	45	47	48	50	51	51
Long Term												
Full Simulation Period ^b	53	51	47	45	44	45	47	48	50	51	52	53
Water Year Types ^c												
Wet (32%)	50	48	45	44	44	45	46	48	49	51	52	51
Above Normal (16%)	53	51	47	44	44	45	46	48	49	51	52	51
Below Normal (13%)	52	50	46	44	44	45	47	48	49	52	52	53
Dry (24%)	53	51	47	45	45	46	47	48	49	52	53	53
Critical (15%)	54	52	48	46	45	46	48	49	50	52	54	56

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-0.1
0.2	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.1	0.0	0.0
0.3	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.0	-0.1	-0.1	0.2
0.4	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.0	-0.1
0.5	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	-0.1
0.6	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	-0.3	-0.1	-0.1	0.0
0.7	0.0	0.1	0.0	0.0	0.0	0.0	-0.1	-0.1	0.0	-0.1	0.0	0.0
0.8	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	-0.1	0.0	0.0	0.0	-0.1
0.9	0.1	-0.1	-0.1	0.1	0.0	0.0	-0.1	0.0	0.0	0.0	-0.1	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.1
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	-0.1	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	-0.1	-0.1	0.0
Critical (15%)	-0.1	-0.2	-0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.0	-0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-2-6. Clear Creek below Whiskeytown, Monthly Temperature

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	55	52	49	46	46	47	48	50	51	53	54	55
20%	54	52	48	45	45	46	48	49	50	52	53	54
30%	53	51	47	45	45	46	47	49	50	52	53	53
40%	53	51	47	45	45	45	47	48	50	52	53	53
50%	52	50	46	44	44	45	47	48	50	51	52	53
60%	52	50	46	44	44	45	46	48	49	51	52	52
70%	51	50	46	44	44	45	46	48	49	51	52	52
80%	51	50	46	44	44	45	46	47	49	51	52	51
90%	50	49	45	43	43	44	45	47	48	50	51	51
Long Term												
Full Simulation Period ^b	53	51	47	45	44	45	47	48	50	51	52	53
Water Year Types ^c												
Wet (32%)	50	48	45	44	44	45	46	48	49	51	52	51
Above Normal (16%)	53	51	47	44	44	45	46	48	49	51	52	51
Below Normal (13%)	52	50	46	44	44	45	47	48	49	52	52	53
Dry (24%)	53	51	47	45	45	46	47	48	50	52	53	53
Critical (15%)	55	52	48	46	45	46	48	49	50	52	54	56

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 5												
Probability of Exceedance ^a												
10%	56	53	49	46	46	47	48	49	51	53	54	55
20%	54	52	48	45	45	46	48	49	50	52	53	54
30%	54	51	47	45	45	46	47	48	50	52	53	53
40%	53	51	47	45	45	45	47	48	50	51	52	53
50%	52	50	47	44	44	45	47	48	50	51	52	52
60%	52	50	46	44	44	45	46	48	49	51	52	52
70%	51	50	46	44	44	45	46	47	49	51	52	51
80%	51	50	46	44	44	45	46	47	49	51	52	51
90%	50	49	46	43	43	44	46	46	48	50	51	51
Long Term												
Full Simulation Period ^b	53	51	47	45	45	45	47	48	50	51	52	53
Water Year Types ^c												
Wet (32%)	50	48	45	44	44	45	46	48	49	51	52	51
Above Normal (16%)	53	51	47	44	44	45	46	48	49	51	52	51
Below Normal (13%)	52	50	47	44	44	45	47	48	49	52	52	53
Dry (24%)	53	51	47	45	45	46	47	48	50	52	53	53
Critical (15%)	55	52	48	46	46	46	48	49	51	52	53	56

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 5 minus Second Basis of Comparison												
Probability of Exceedance ^a												
0.1	0.9	0.3	0.1	0.0	0.1	0.0	0.0	-0.2	0.5	0.1	0.0	0.0
0.2	0.3	0.2	0.0	0.0	0.0	0.0	0.1	-0.2	0.1	0.0	0.1	0.1
0.3	0.4	0.1	0.1	0.0	0.0	0.1	0.0	-0.3	0.0	0.0	-0.3	0.4
0.4	0.0	0.0	0.0	0.0	0.0	0.2	0.1	-0.2	0.0	-0.1	-0.1	0.1
0.5	0.1	-0.1	0.1	0.0	0.0	0.1	0.0	-0.3	0.0	-0.1	-0.1	-0.1
0.6	-0.3	0.0	0.0	0.0	0.1	0.0	0.0	-0.2	-0.1	-0.1	-0.2	0.0
0.7	-0.1	0.0	0.0	0.1	0.1	0.0	-0.1	-0.3	0.1	-0.2	-0.1	-0.1
0.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.3	-0.1	0.0	-0.1	-0.1
0.9	0.0	0.1	0.2	0.1	0.0	0.0	0.1	-0.6	0.0	0.0	-0.1	-0.1
Long Term												
Full Simulation Period ^b	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.2	0.1	0.0	-0.1	0.0
Water Year Types ^c												
Wet (32%)	-0.1	0.1	0.0	0.0	0.0	0.1	0.0	-0.3	0.1	0.0	-0.1	-0.2
Above Normal (16%)	0.2	0.1	0.0	0.1	0.0	0.0	-0.1	-0.4	0.0	0.0	0.0	0.1
Below Normal (13%)	0.0	0.0	0.2	0.0	0.0	0.1	0.1	-0.2	-0.1	-0.1	0.0	0.1
Dry (24%)	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.2	0.1	0.0	0.0	0.1
Critical (15%)	0.2	0.2	0.1	0.0	0.1	0.0	0.1	0.2	0.5	0.1	-0.3	-0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


B.3. Clear Creek at Igo Temperature

Figure B-3-1. Clear Creek at Igo, October




Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-3-2. Clear Creek at Igo, November

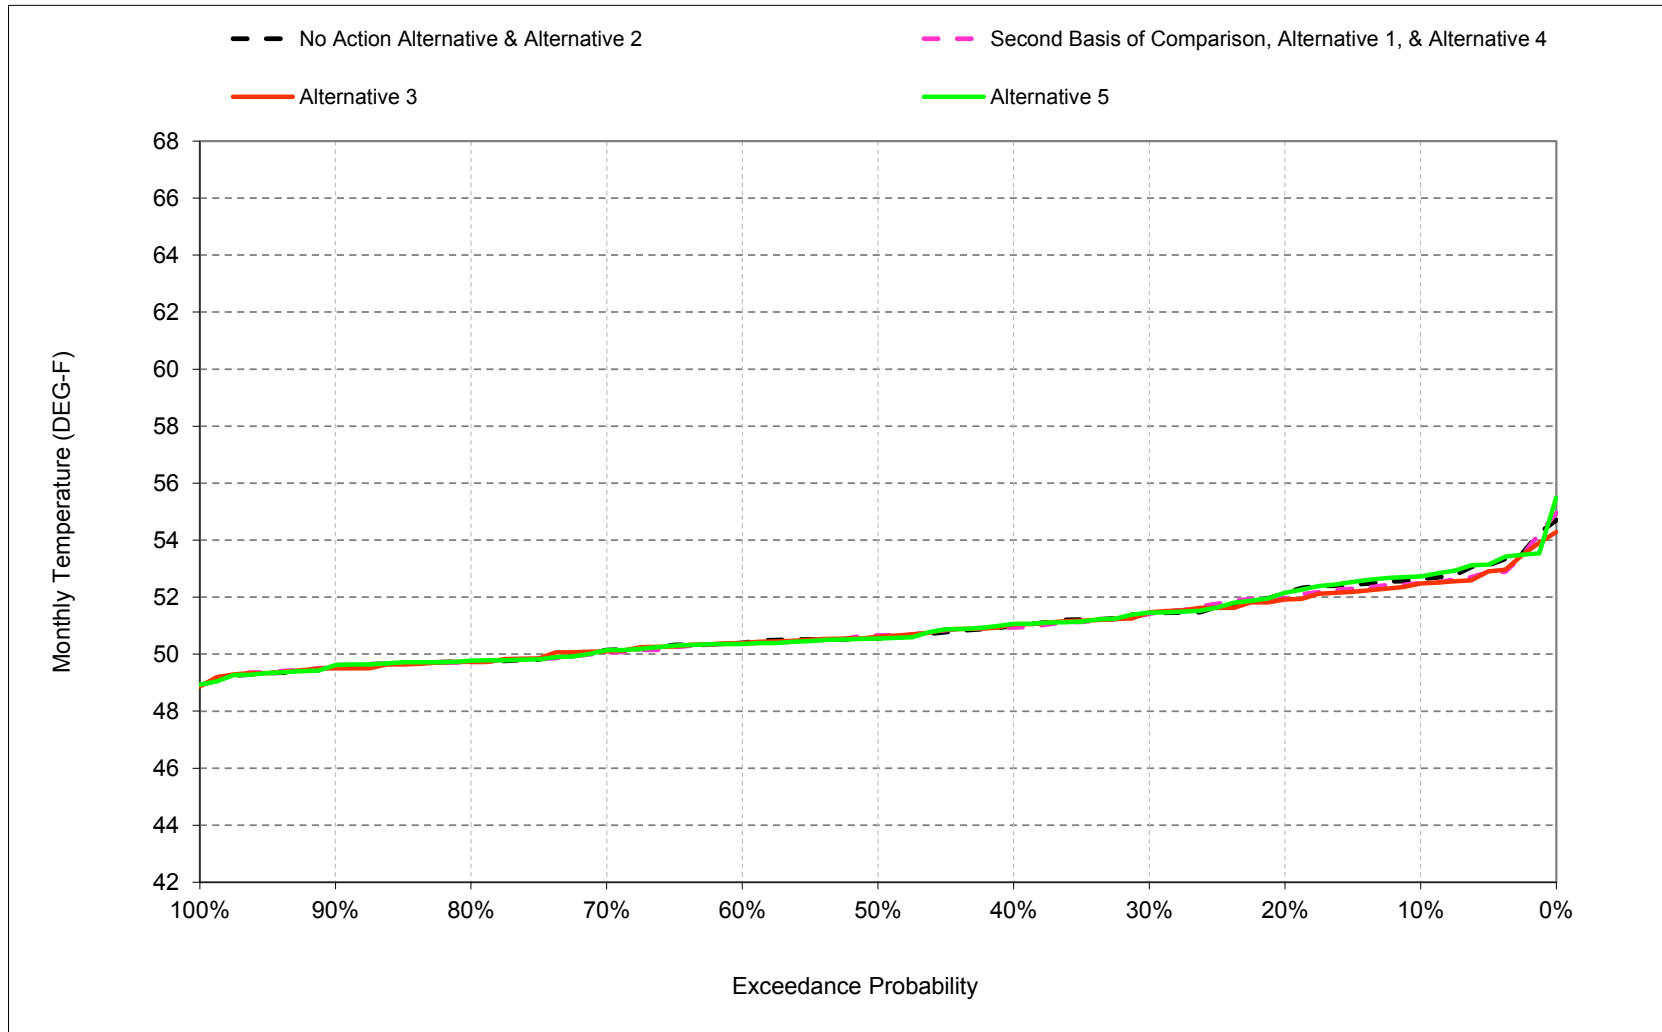


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-3-3. Clear Creek at Igo, December

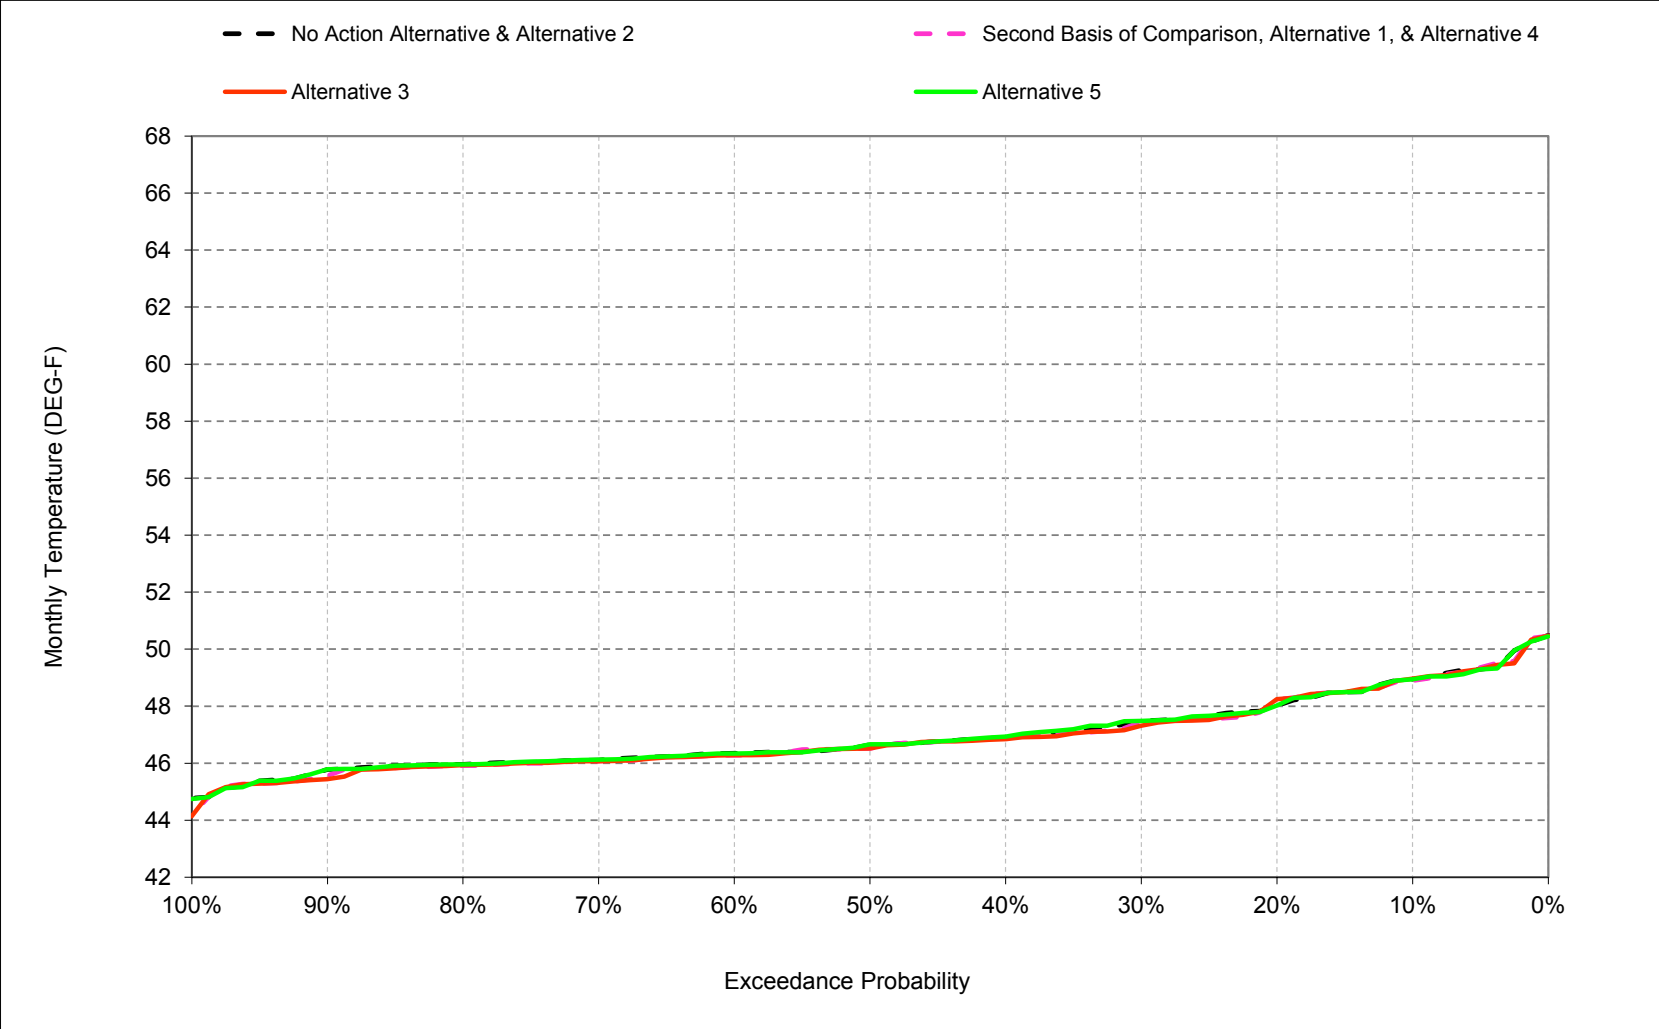


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-3-4. Clear Creek at Igo, January

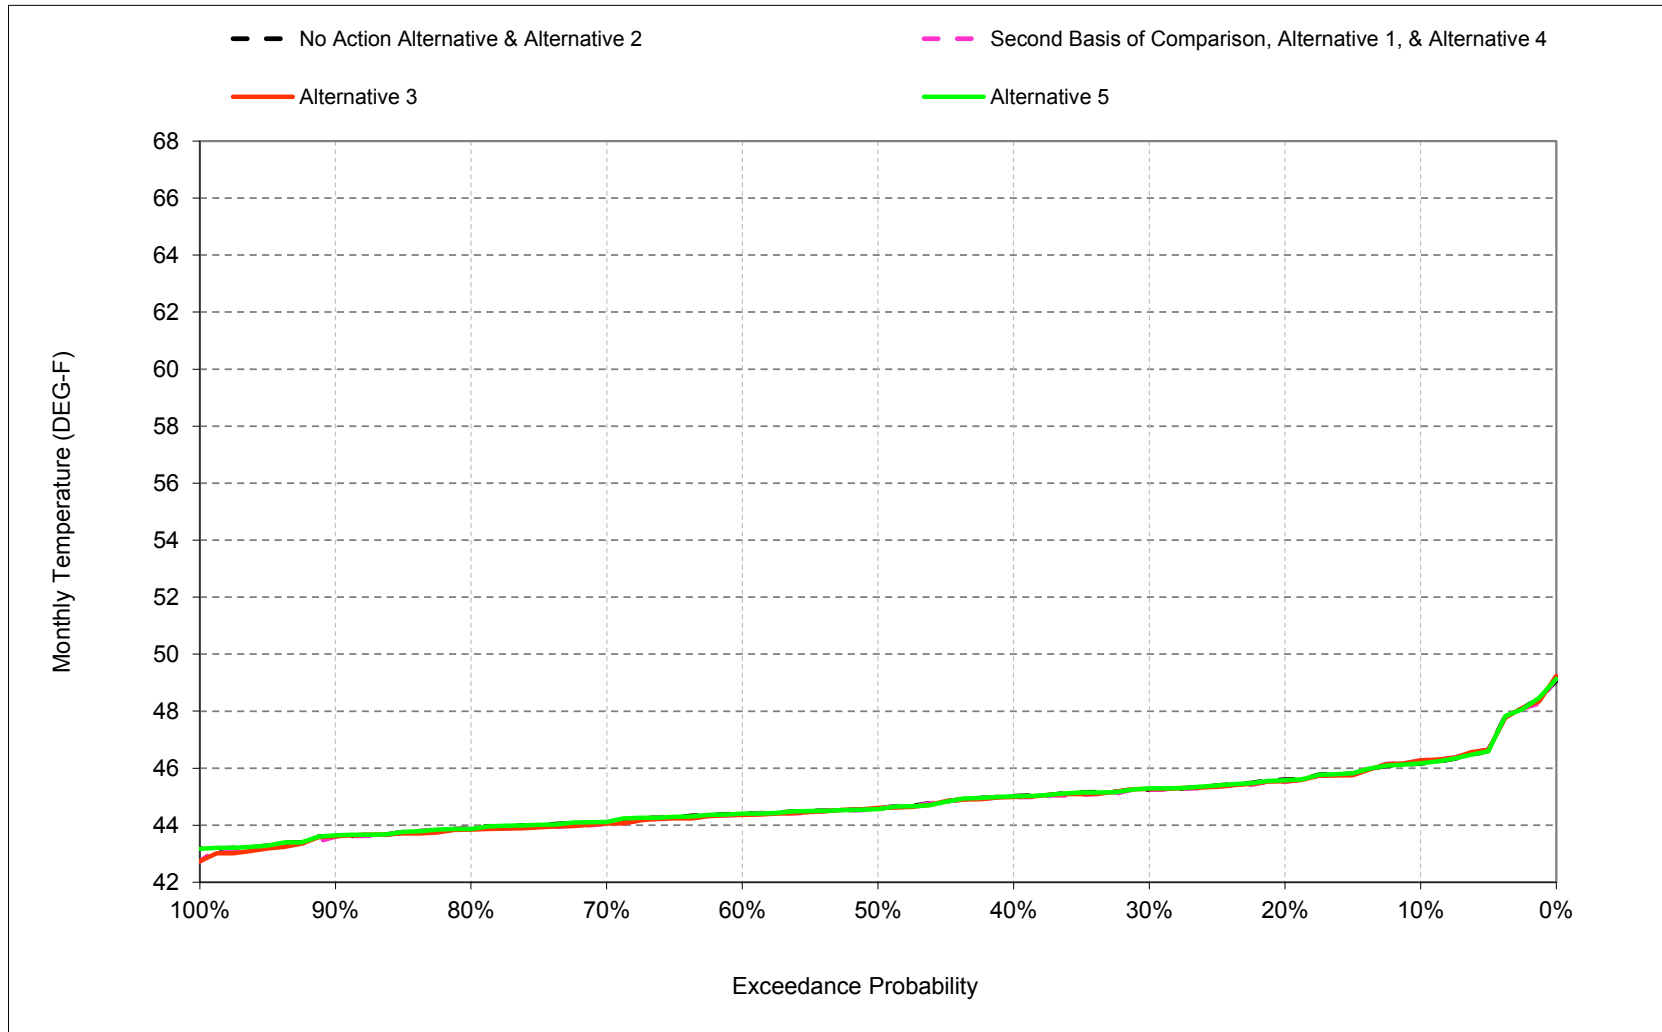


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-3-5. Clear Creek at Igo, February

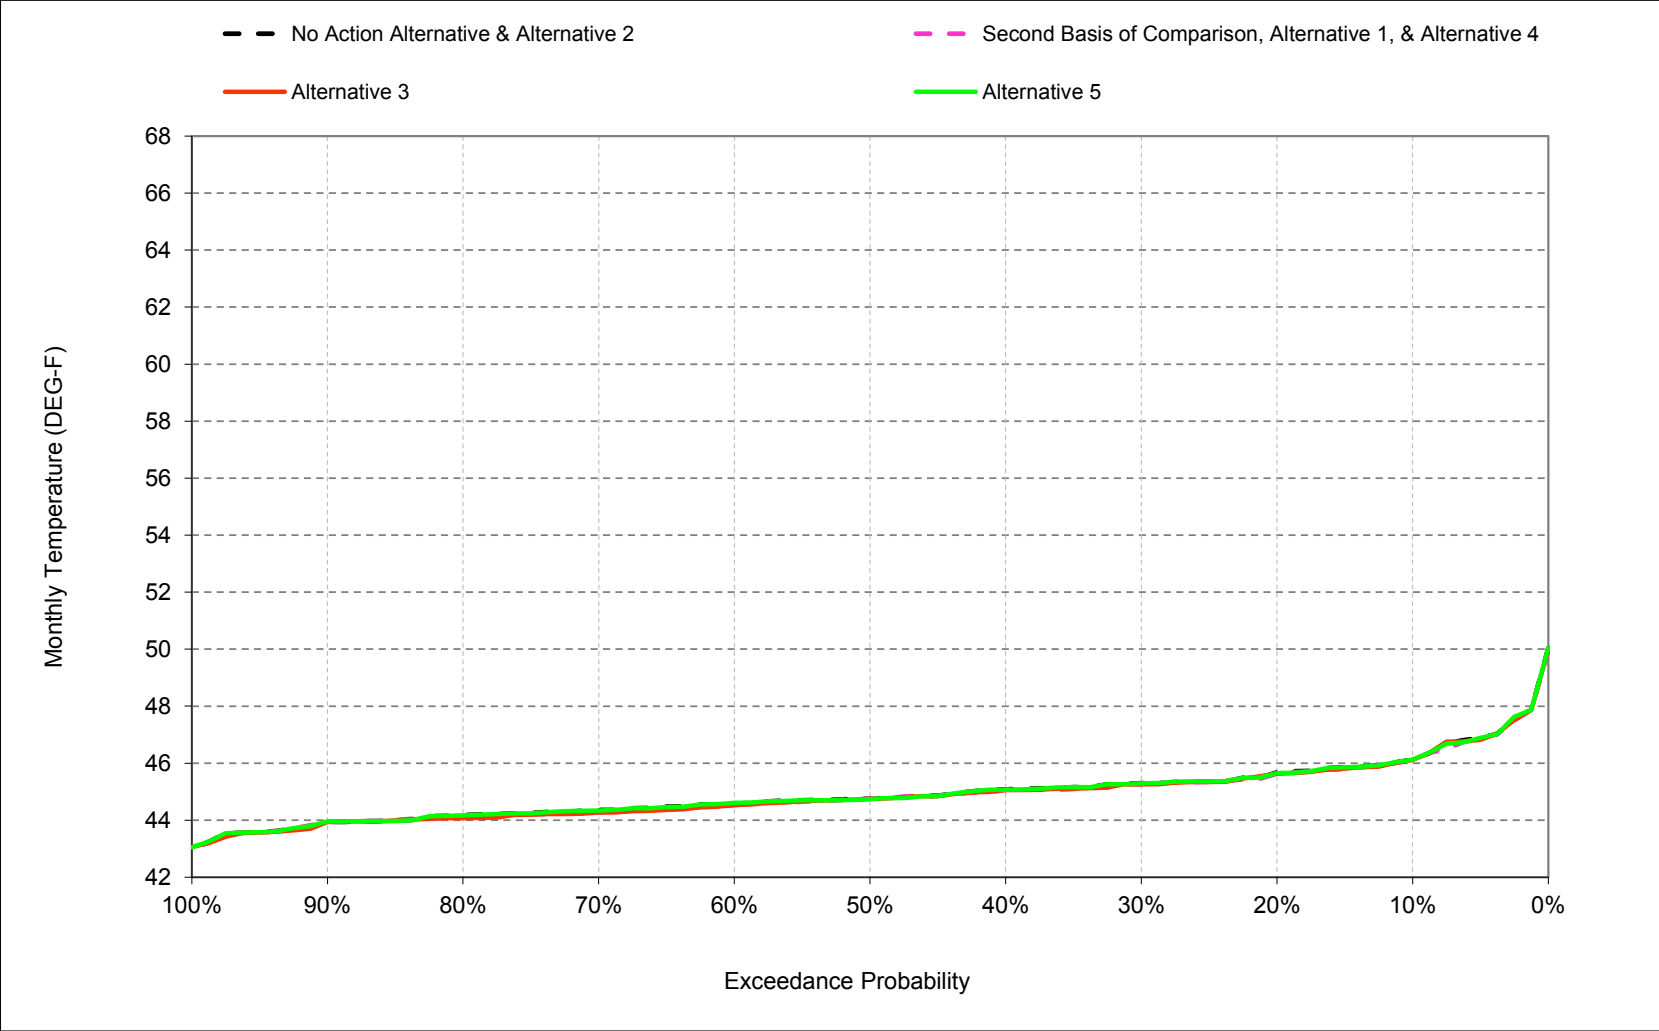


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-3-6. Clear Creek at Igo, March

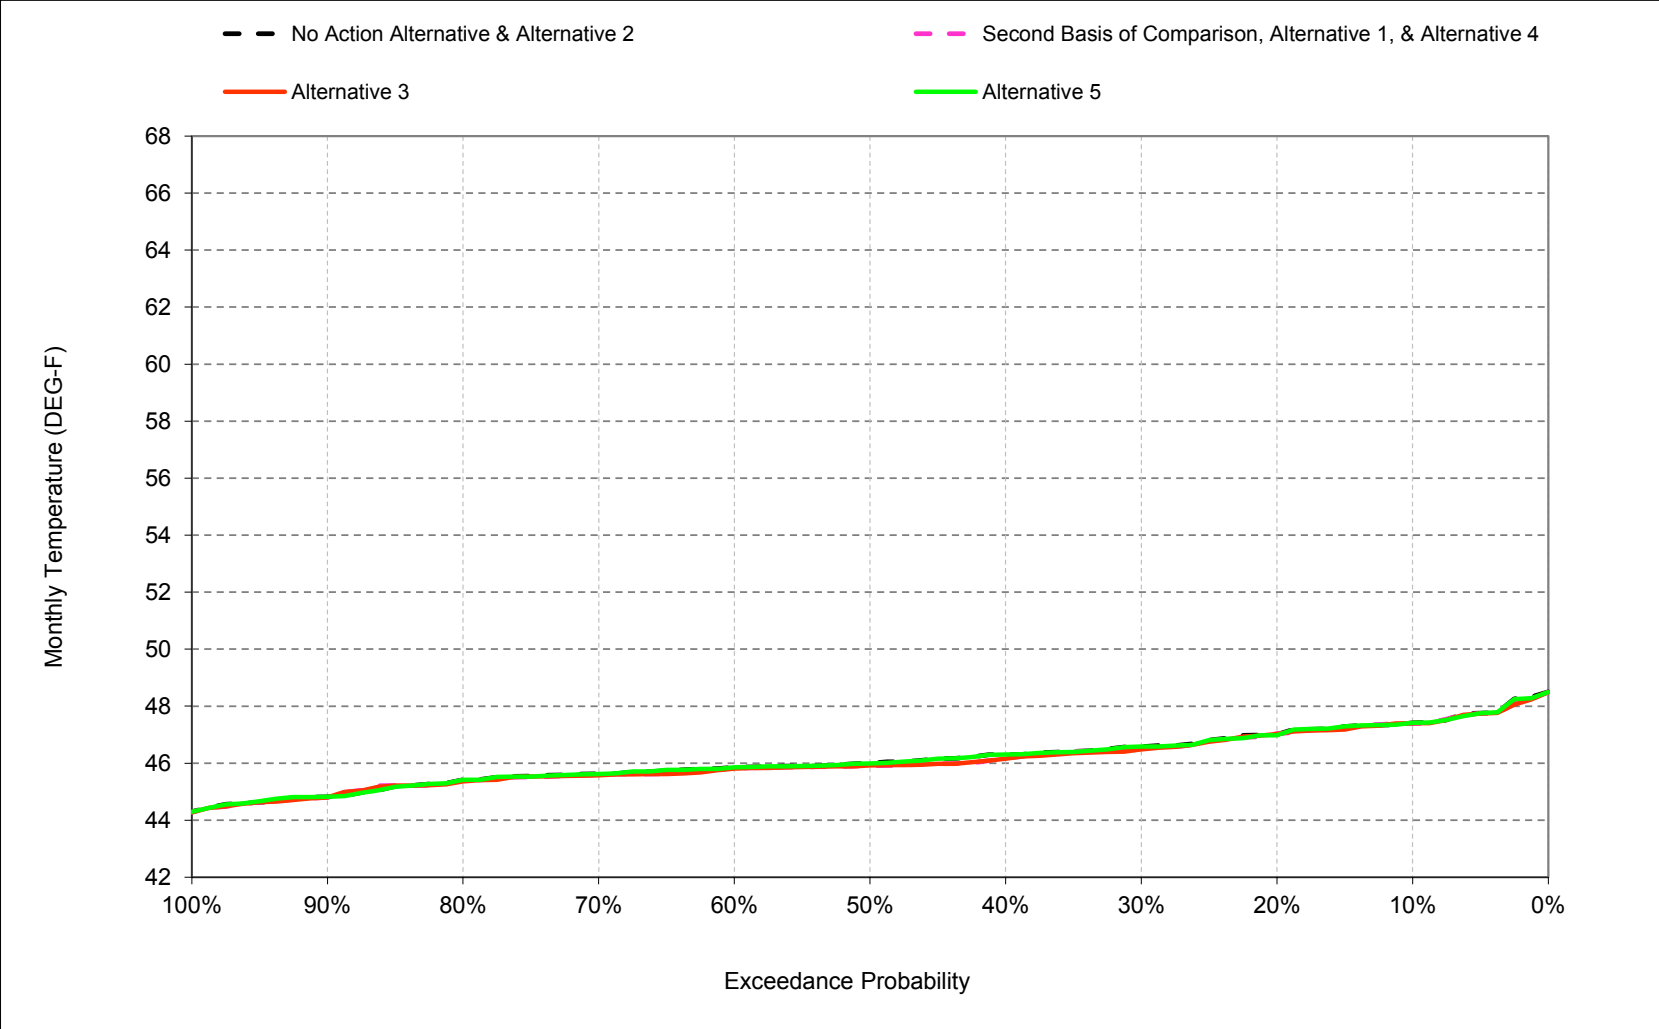


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-3-7. Clear Creek at Igo, April

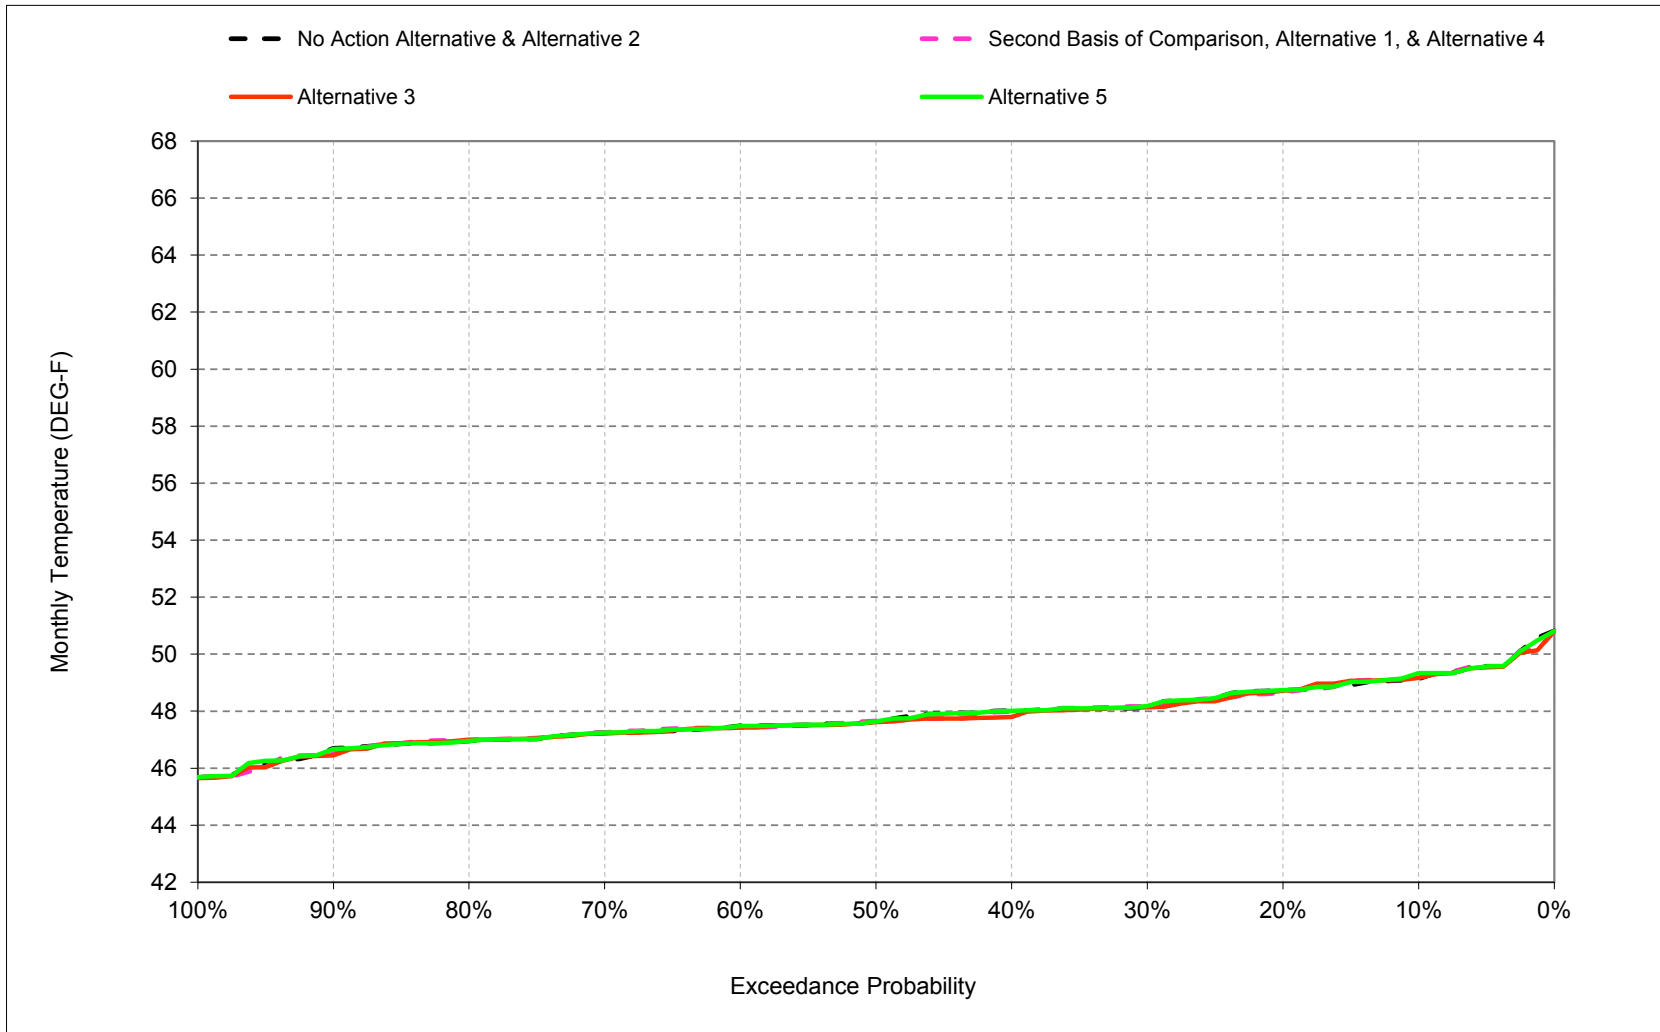


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-3-8. Clear Creek at Igo, May

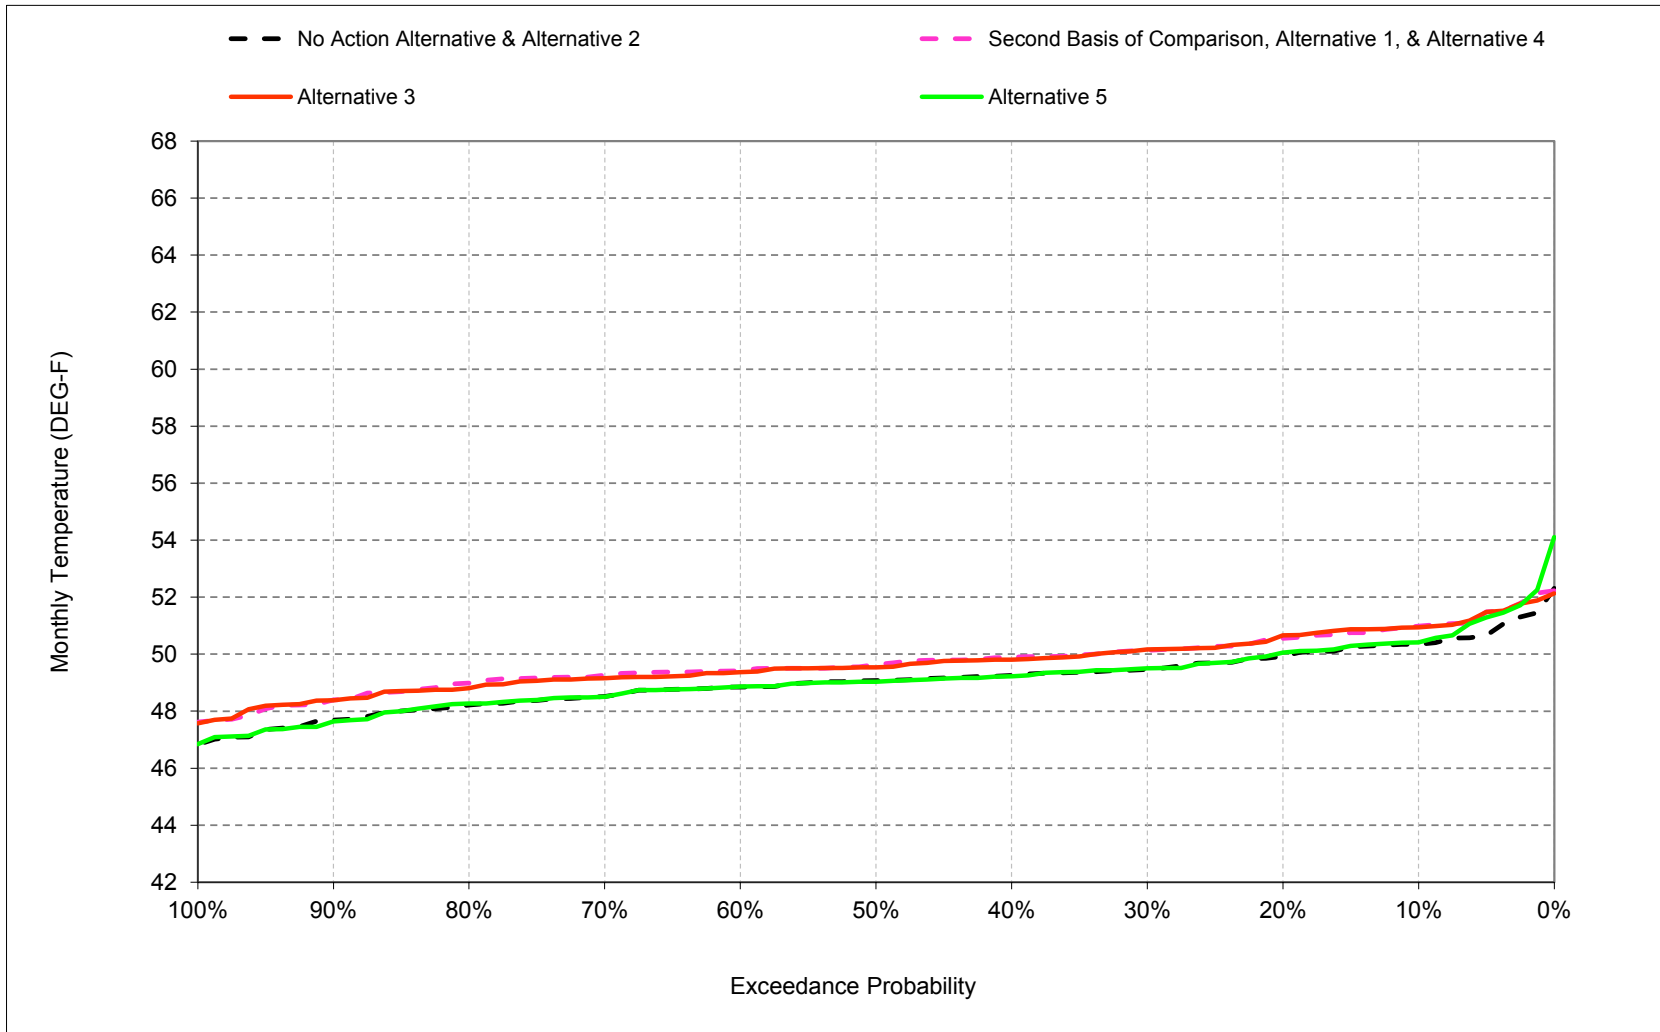


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-3-9. Clear Creek at Igo, June

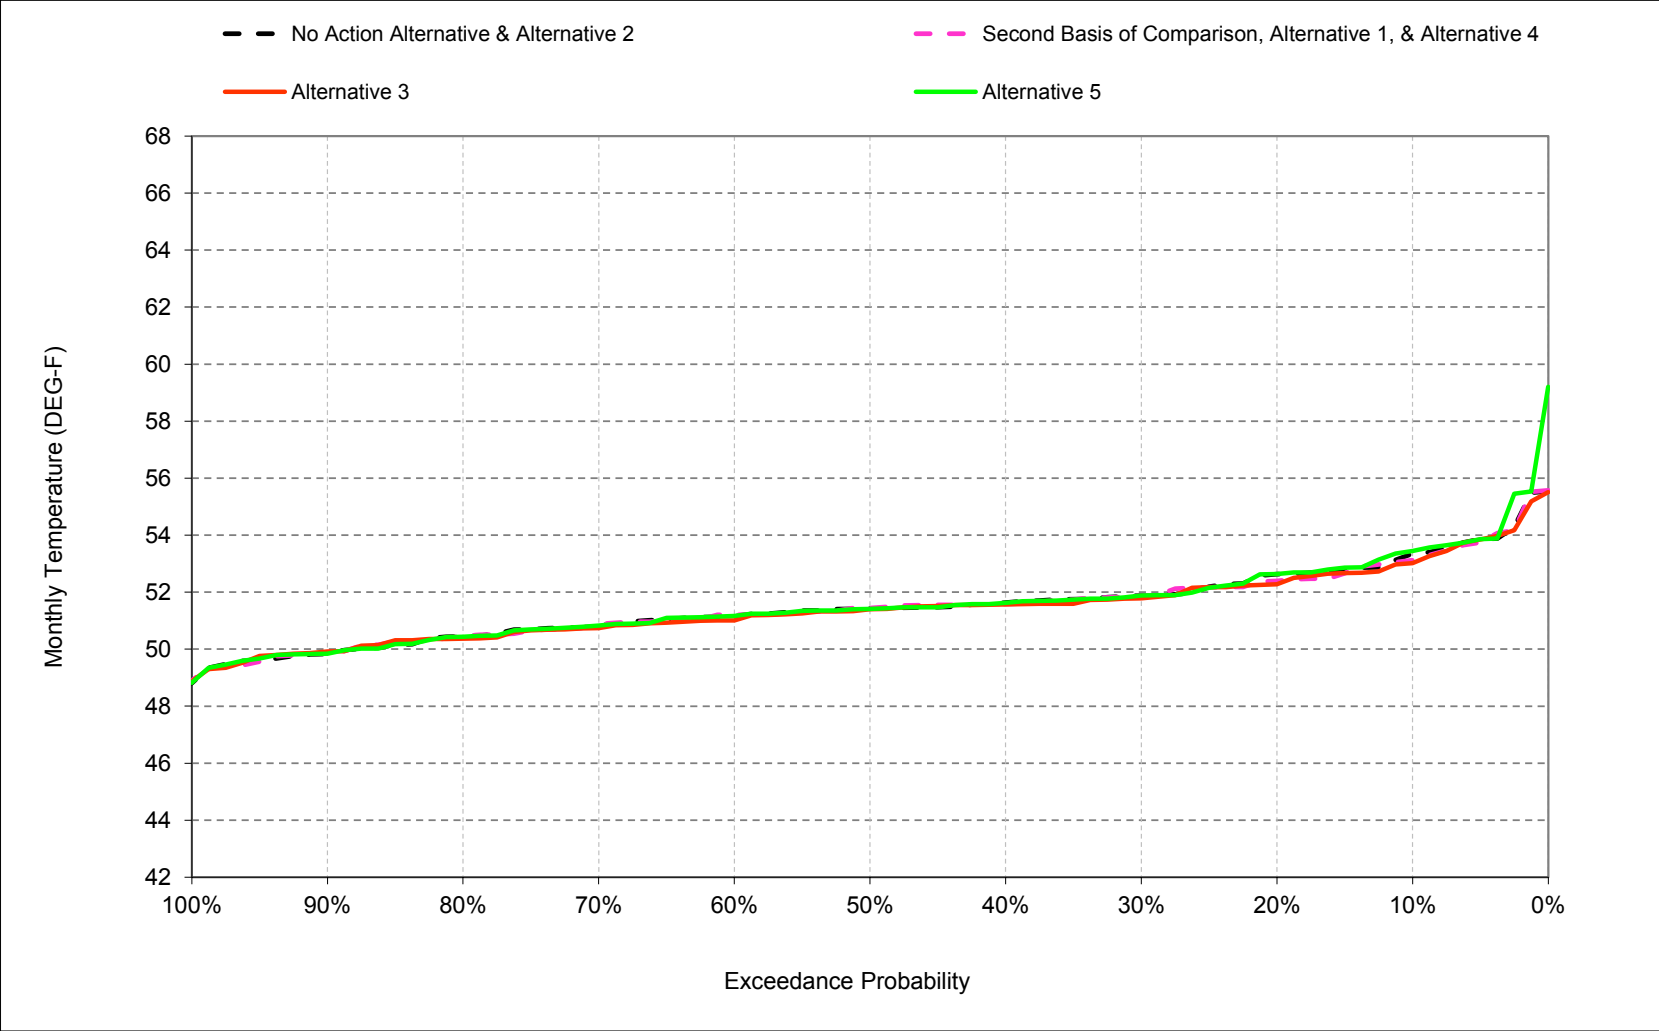


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-3-10. Clear Creek at Igo, July

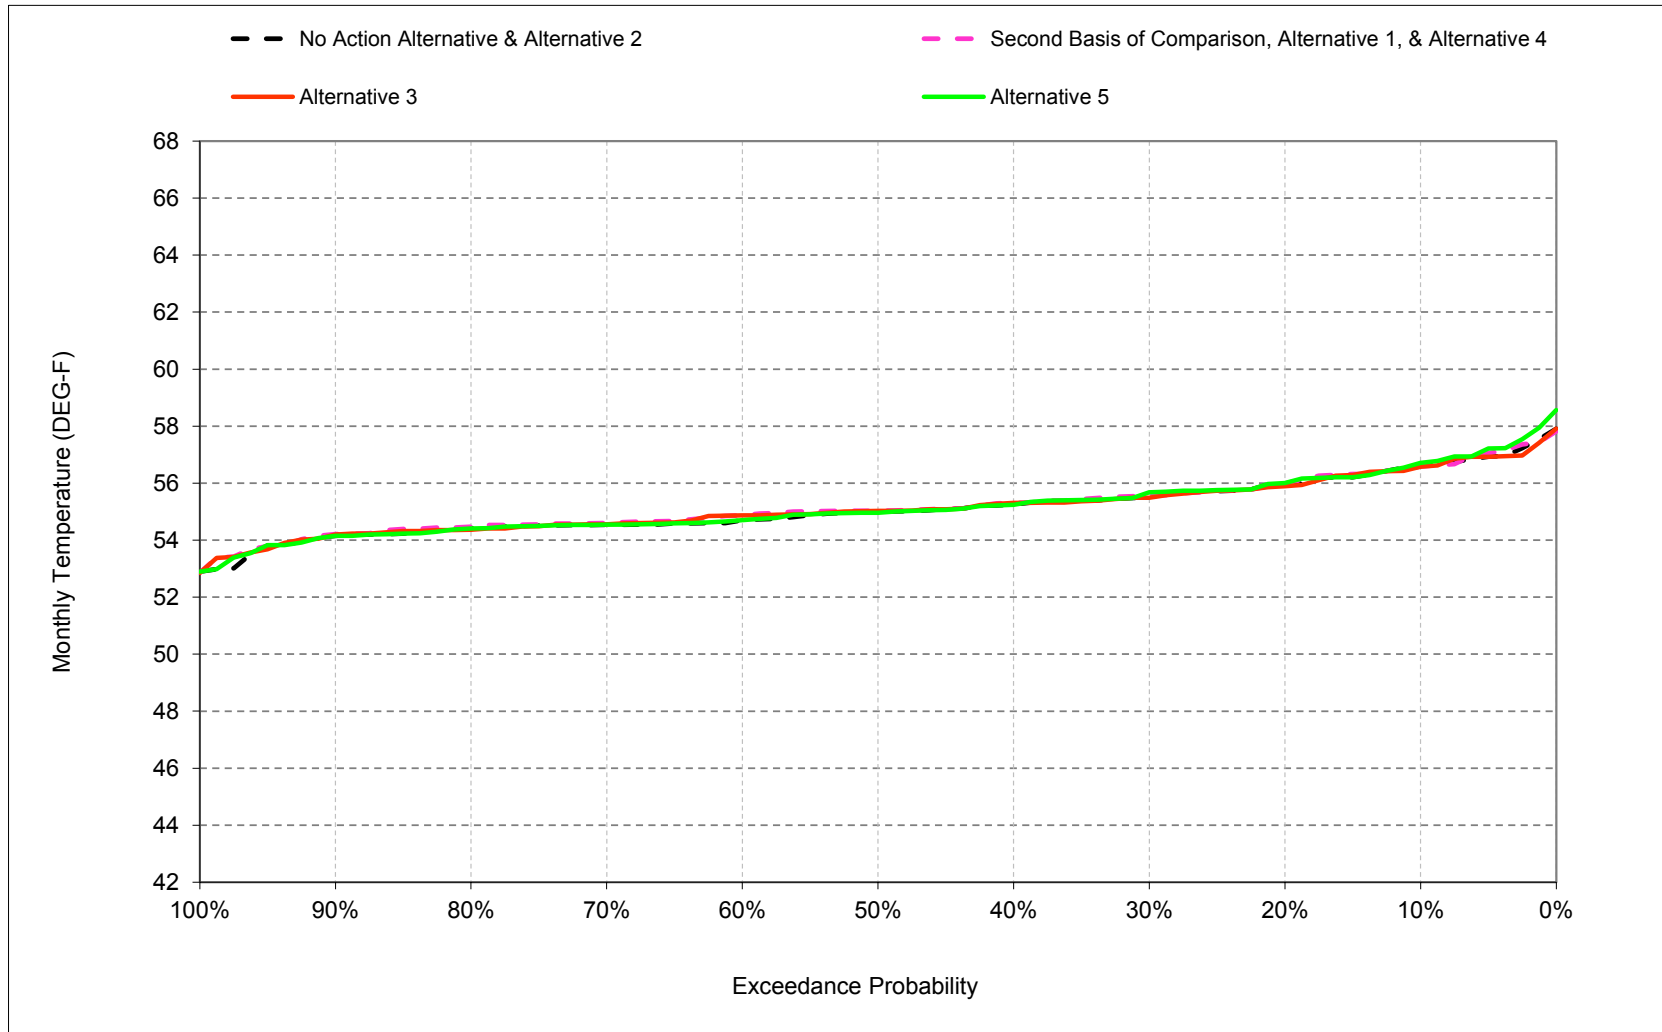


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-3-11. Clear Creek at Igo, August

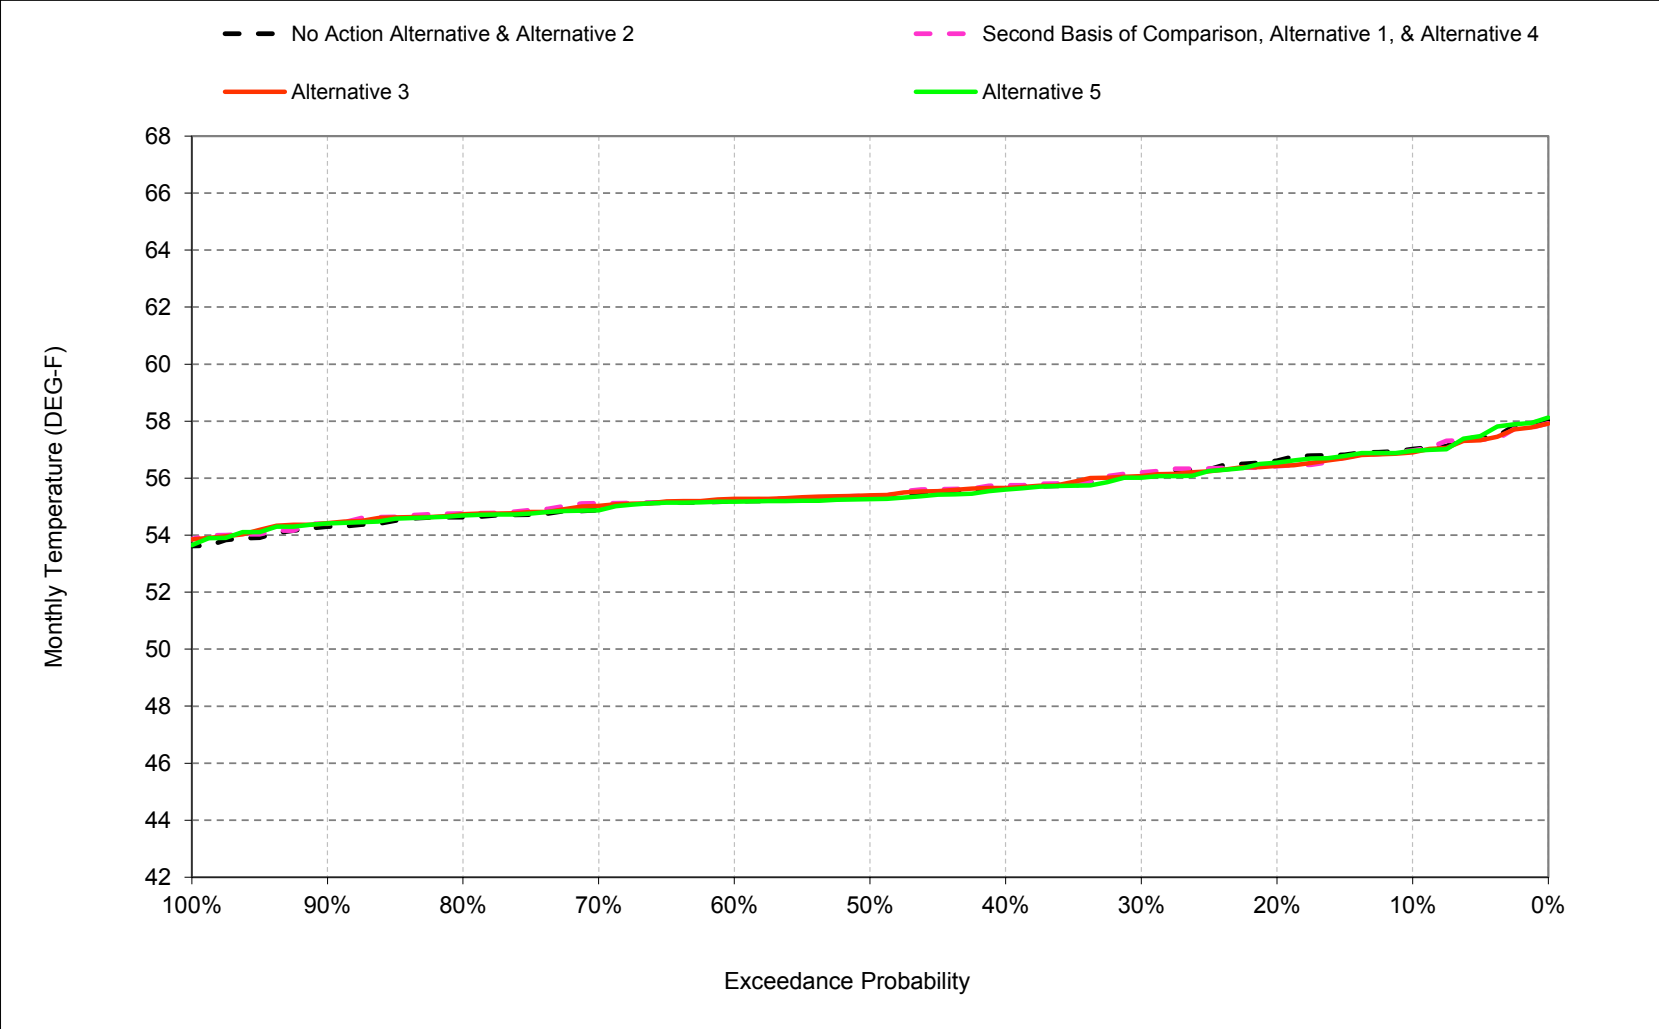

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-3-12. Clear Creek at Igo, September

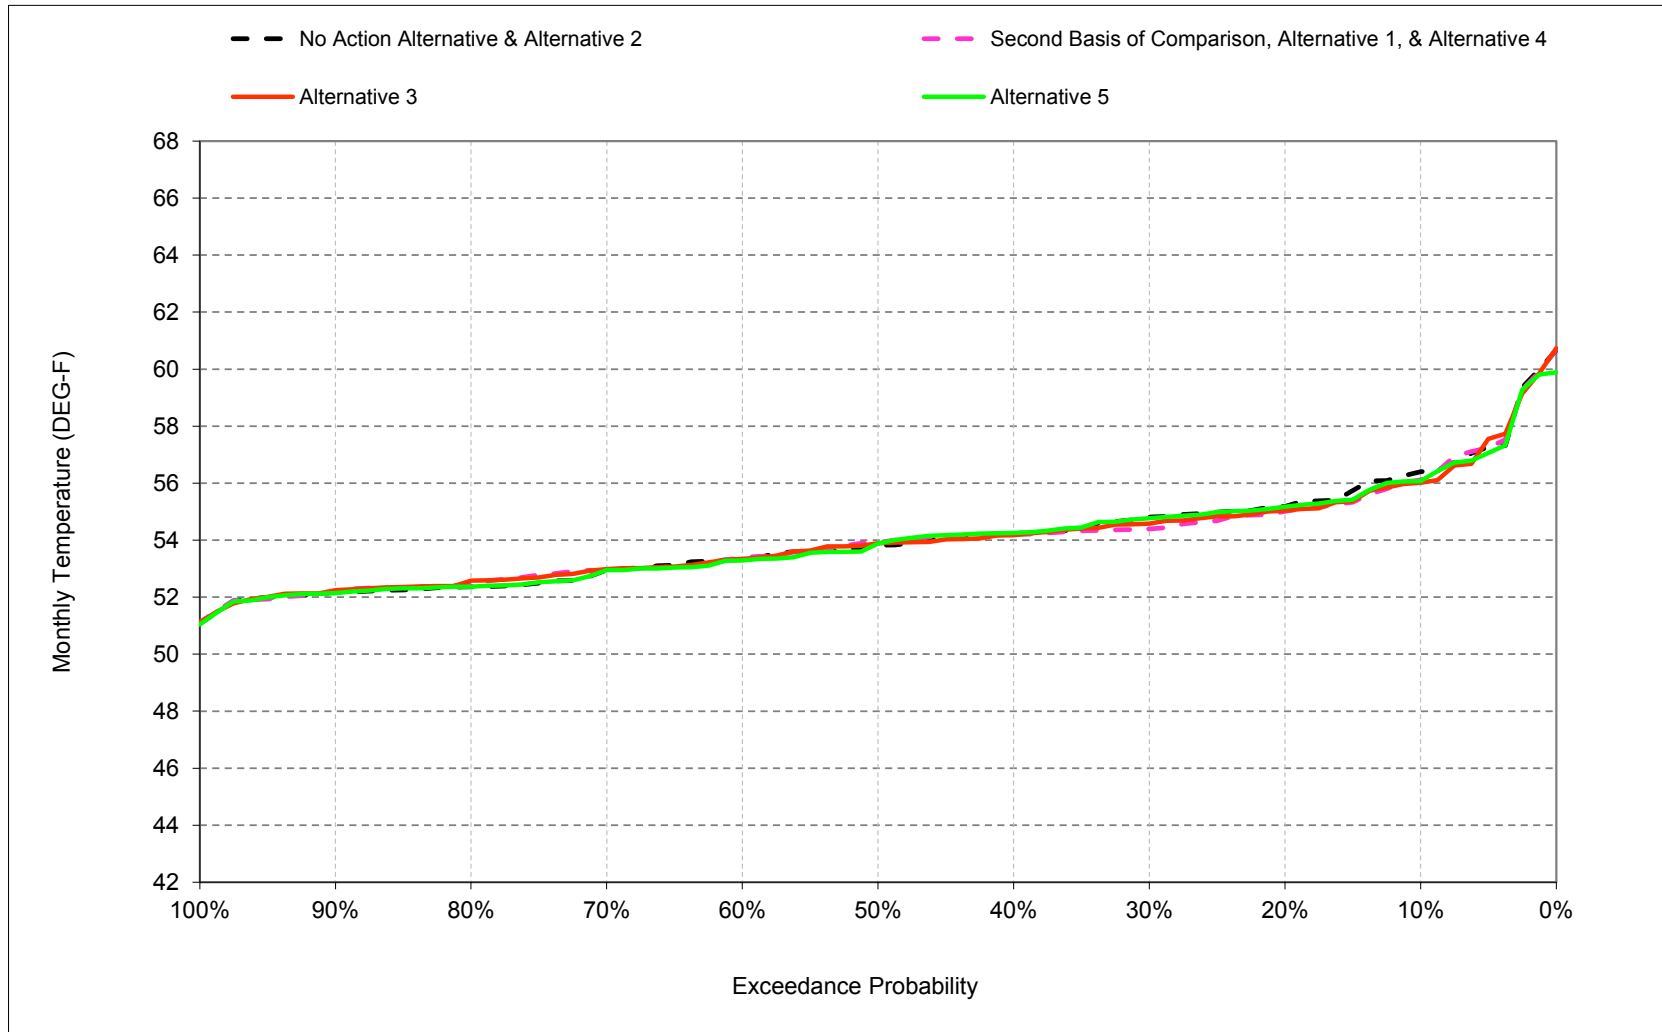

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-3-1. Clear Creek at Igo, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	56	53	49	46	46	47	49	50	53	57	57	56
20%	55	52	48	46	46	47	49	50	53	56	57	55
30%	54	51	47	45	45	47	48	49	52	55	56	55
40%	54	51	47	45	45	46	48	49	52	55	56	54
50%	53	51	47	45	45	46	48	49	51	55	55	54
60%	52	50	46	44	45	46	47	49	51	55	55	53
70%	52	50	46	44	44	46	47	48	51	55	55	53
80%	51	50	46	44	44	45	47	48	50	54	55	52
90%	51	50	46	44	44	45	46	48	50	54	54	52
Long Term												
Full Simulation Period ^b	53	51	47	45	45	46	48	49	51	55	56	54
Water Year Types ^c												
Wet (32%)	50	48	45	45	45	46	47	49	51	55	55	53
Above Normal (16%)	53	51	47	45	45	46	47	49	51	55	55	53
Below Normal (13%)	52	50	47	44	45	46	48	49	51	55	55	54
Dry (24%)	54	51	47	45	45	46	48	49	51	55	56	55
Critical (15%)	55	53	48	46	46	47	49	50	53	55	57	57

Alternative 1												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	56	52	49	46	46	47	49	51	53	57	57	56
20%	55	52	48	46	46	47	49	51	52	56	56	55
30%	54	51	47	45	45	47	48	50	52	56	56	54
40%	54	51	47	45	45	46	48	50	52	55	56	54
50%	53	51	47	45	45	46	48	50	51	55	55	54
60%	52	50	46	44	44	46	47	49	51	55	55	53
70%	52	50	46	44	44	46	47	49	51	55	55	53
80%	51	50	46	44	44	45	47	49	50	54	55	52
90%	51	50	46	43	44	45	46	48	50	54	54	52
Long Term												
Full Simulation Period ^b	53	51	47	45	45	46	48	50	51	55	56	54
Water Year Types ^c												
Wet (32%)	50	48	45	44	45	46	47	49	51	55	55	53
Above Normal (16%)	53	51	47	45	45	46	47	49	51	55	55	53
Below Normal (13%)	52	50	46	44	45	46	48	50	51	55	55	54
Dry (24%)	53	51	47	45	45	46	48	50	51	55	56	54
Critical (15%)	55	53	48	46	46	47	49	51	53	56	57	57

Alternative 1 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.1	-0.2	-0.1	0.1	0.0	0.0	0.1	0.6	-0.2	-0.1	0.0	-0.3
0.2	-0.4	-0.2	0.2	-0.1	0.0	0.0	-0.1	0.6	-0.2	0.0	-0.2	-0.2
0.3	-0.4	0.0	0.0	0.0	0.0	-0.1	0.1	0.7	0.0	0.1	0.1	-0.4
0.4	-0.1	0.0	0.0	0.0	0.0	-0.2	0.0	0.6	0.0	0.1	0.1	0.0
0.5	-0.2	0.1	-0.1	0.0	0.0	-0.1	0.0	0.5	0.0	0.1	0.1	0.1
0.6	0.1	0.0	-0.1	0.0	-0.1	0.0	0.0	0.6	0.1	0.2	0.0	0.0
0.7	0.1	-0.1	0.0	-0.1	-0.1	0.0	0.0	0.7	0.0	0.1	0.2	0.0
0.8	0.1	0.0	0.0	0.0	-0.1	0.0	0.1	0.8	0.0	0.1	0.1	0.1
0.9	0.1	-0.1	-0.2	-0.2	0.0	0.0	0.0	0.6	0.0	0.1	0.1	0.0
Long Term												
Full Simulation Period ^b	-0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.6	0.0	0.1	0.1	0.0
Water Year Types ^c												
Wet (32%)	0.1	-0.1	0.0	0.0	0.0	-0.1	0.0	0.6	0.0	0.1	0.1	0.1
Above Normal (16%)	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.7	0.0	0.0	0.0	-0.1
Below Normal (13%)	-0.1	0.0	-0.2	0.0	0.0	-0.1	-0.1	0.8	0.2	0.1	0.1	0.0
Dry (24%)	-0.5	0.0	0.0	0.0	0.0	0.0	0.0	0.6	-0.1	0.0	0.0	-0.1
Critical (15%)	-0.3	-0.1	-0.1	0.0	-0.1	0.0	-0.1	0.4	0.0	0.1	0.1	-0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-3-2. Clear Creek at Igo, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	56	53	49	46	46	47	49	50	53	57	57	56
20%	55	52	48	46	46	47	49	50	53	56	57	55
30%	54	51	47	45	45	47	48	49	52	55	56	55
40%	54	51	47	45	45	46	48	49	52	55	56	54
50%	53	51	47	45	45	46	48	49	51	55	55	54
60%	52	50	46	44	45	46	47	49	51	55	55	53
70%	52	50	46	44	44	46	47	48	51	55	55	53
80%	51	50	46	44	44	45	47	48	50	54	55	52
90%	51	50	46	44	44	45	46	48	50	54	54	52
Long Term												
Full Simulation Period ^b	53	51	47	45	45	46	48	49	51	55	56	54
Water Year Types ^c												
Wet (32%)	50	48	45	45	45	46	47	49	51	55	55	53
Above Normal (16%)	53	51	47	45	45	46	47	49	51	55	55	53
Below Normal (13%)	52	50	47	44	45	46	48	49	51	55	55	54
Dry (24%)	54	51	47	45	45	46	48	49	51	55	56	55
Critical (15%)	55	53	48	46	46	47	49	50	53	55	57	57

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	56	52	49	46	46	47	49	51	53	57	57	56
20%	55	52	48	46	46	47	49	51	52	56	56	55
30%	54	51	47	45	45	46	48	50	52	55	56	55
40%	54	51	47	45	45	46	48	50	52	55	56	54
50%	53	51	47	45	45	46	48	50	51	55	55	54
60%	52	50	46	44	44	46	47	49	51	55	55	53
70%	52	50	46	44	44	46	47	49	51	55	55	53
80%	51	50	46	44	44	45	47	49	50	54	55	53
90%	51	49	45	44	44	45	46	48	50	54	54	52
Long Term												
Full Simulation Period ^b	53	51	47	45	45	46	48	50	51	55	56	54
Water Year Types ^c												
Wet (32%)	50	48	45	44	45	46	47	49	51	55	55	53
Above Normal (16%)	53	51	47	45	45	46	47	49	51	55	55	53
Below Normal (13%)	52	50	46	44	45	46	48	49	51	55	55	54
Dry (24%)	53	51	47	45	45	46	48	50	51	55	56	54
Critical (15%)	55	52	48	46	46	47	49	51	53	55	57	57

Alternative 3 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.1	-0.2	0.0	0.1	0.0	0.0	0.0	0.6	-0.3	-0.1	-0.1	-0.4
0.2	-0.3	-0.2	0.2	-0.1	0.0	0.0	0.0	0.7	-0.4	-0.1	-0.2	-0.1
0.3	-0.2	0.1	-0.2	0.0	0.0	-0.1	0.0	0.7	-0.1	0.0	0.0	-0.2
0.4	-0.1	0.1	0.0	0.0	0.0	-0.2	-0.2	0.6	0.0	0.1	0.0	-0.1
0.5	-0.1	0.1	-0.1	0.0	0.0	-0.1	0.0	0.5	-0.1	0.0	0.1	0.1
0.6	0.2	0.0	-0.1	0.0	-0.1	0.0	0.0	0.5	-0.1	0.2	0.1	0.0
0.7	0.1	0.0	0.0	-0.1	-0.1	-0.1	0.0	0.7	0.0	0.0	0.2	0.0
0.8	0.1	0.0	0.0	0.0	-0.1	0.0	0.0	0.6	-0.1	0.0	0.0	0.2
0.9	0.0	-0.1	-0.3	0.0	-0.1	0.0	0.0	0.7	0.1	0.0	0.1	0.1
Long Term												
Full Simulation Period ^b	-0.2	-0.1	-0.1	0.0	0.0	-0.1	0.0	0.6	-0.1	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.1	-0.1	0.0	-0.1	0.0	-0.1	0.0	0.6	0.0	0.1	0.1	0.2
Above Normal (16%)	-0.1	0.0	-0.1	-0.1	0.0	0.0	0.0	0.7	-0.1	0.0	0.0	-0.1
Below Normal (13%)	0.0	0.0	-0.2	0.0	-0.1	-0.1	-0.1	0.8	0.1	0.1	0.1	-0.1
Dry (24%)	-0.5	0.0	0.0	0.0	0.0	0.0	-0.1	0.6	-0.2	-0.1	-0.1	-0.1
Critical (15%)	-0.4	-0.3	-0.2	-0.1	-0.1	-0.1	-0.1	0.4	-0.1	0.0	0.1	-0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-3-3. Clear Creek at Igo, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	56	53	49	46	46	47	49	50	53	57	57	56
20%	55	52	48	46	46	47	49	50	53	56	57	55
30%	54	51	47	45	45	47	48	49	52	55	56	55
40%	54	51	47	45	45	46	48	49	52	55	56	54
50%	53	51	47	45	45	46	48	49	51	55	55	54
60%	52	50	46	44	45	46	47	49	51	55	55	53
70%	52	50	46	44	44	46	47	48	51	55	55	53
80%	51	50	46	44	44	45	47	48	50	54	55	52
90%	51	50	46	44	44	45	46	48	50	54	54	52
Long Term												
Full Simulation Period ^b	53	51	47	45	45	46	48	49	51	55	56	54
Water Year Types^c												
Wet (32%)	50	48	45	45	45	46	47	49	51	55	55	53
Above Normal (16%)	53	51	47	45	45	46	47	49	51	55	55	53
Below Normal (13%)	52	50	47	44	45	46	48	49	51	55	55	54
Dry (24%)	54	51	47	45	45	46	48	49	51	55	56	55
Critical (15%)	55	53	48	46	46	47	49	50	53	55	57	57

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	56	53	49	46	46	47	49	50	53	57	57	56
20%	55	52	48	46	46	47	49	50	53	56	57	55
30%	54	51	47	45	45	47	48	49	52	56	56	55
40%	54	51	47	45	45	46	48	49	52	55	56	54
50%	53	51	47	45	45	46	48	49	51	55	55	54
60%	52	50	46	44	45	46	47	49	51	55	55	53
70%	52	50	46	44	44	46	47	48	51	55	55	53
80%	51	50	46	44	44	45	47	48	50	54	55	52
90%	51	50	46	44	44	45	46	47	50	54	54	52
Long Term												
Full Simulation Period ^b	53	51	47	45	45	46	48	49	52	55	56	54
Water Year Types^c												
Wet (32%)	50	48	45	45	45	46	47	49	51	55	55	53
Above Normal (16%)	54	51	47	45	45	46	47	49	51	55	55	53
Below Normal (13%)	52	50	47	44	45	46	48	49	51	55	55	54
Dry (24%)	54	51	47	45	45	46	48	49	51	55	56	55
Critical (15%)	55	53	48	46	46	47	49	50	54	56	56	57

Alternative 5 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
0.1	0.2	0.1	0.0	0.0	0.0	0.0	0.2	0.1	0.1	0.1	-0.1	-0.3
0.2	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-0.1	0.0
0.3	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0
0.4	-0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0
0.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0
0.6	-0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
0.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0
0.9	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.2	0.0	0.0	0.1	0.0
Long Term												
Full Simulation Period ^b	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0
Water Year Types^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.1	0.0	0.1	0.1
Dry (24%)	-0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3	0.4	0.2	-0.2	-0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-3-4. Clear Creek at Igo, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	56	52	49	46	46	47	49	51	53	57	57	56
20%	55	52	48	46	46	47	49	51	52	56	56	55
30%	54	51	47	45	45	47	48	50	52	56	56	54
40%	54	51	47	45	45	46	48	50	52	55	56	54
50%	53	51	47	45	45	46	48	50	51	55	55	54
60%	52	50	46	44	44	46	47	49	51	55	55	53
70%	52	50	46	44	44	46	47	49	51	55	55	53
80%	51	50	46	44	44	45	47	49	50	54	55	52
90%	51	50	46	43	44	45	46	48	50	54	54	52
Long Term												
Full Simulation Period ^b	53	51	47	45	45	46	48	50	51	55	56	54
Water Year Types ^c												
Wet (32%)	50	48	45	44	45	46	47	49	51	55	55	53
Above Normal (16%)	53	51	47	45	45	46	47	49	51	55	55	53
Below Normal (13%)	52	50	46	44	45	46	48	50	51	55	55	54
Dry (24%)	53	51	47	45	45	46	48	50	51	55	56	54
Critical (15%)	55	53	48	46	46	47	49	51	53	56	57	57

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	56	53	49	46	46	47	49	50	53	57	57	56
20%	55	52	48	46	46	47	49	50	53	56	57	55
30%	54	51	47	45	45	47	48	49	52	55	56	55
40%	54	51	47	45	45	46	48	49	52	55	56	54
50%	53	51	47	45	45	46	48	49	51	55	55	54
60%	52	50	46	44	45	46	47	49	51	55	55	53
70%	52	50	46	44	44	46	47	48	51	55	55	53
80%	51	50	46	44	44	45	47	48	50	54	55	52
90%	51	50	46	44	44	45	46	48	50	54	54	52
Long Term												
Full Simulation Period ^b	53	51	47	45	45	46	48	49	51	55	56	54
Water Year Types ^c												
Wet (32%)	50	48	45	45	45	46	47	49	51	55	55	53
Above Normal (16%)	53	51	47	45	45	46	47	49	51	55	55	53
Below Normal (13%)	52	50	47	44	45	46	48	49	51	55	55	54
Dry (24%)	54	51	47	45	45	46	48	49	51	55	56	55
Critical (15%)	55	53	48	46	46	47	49	50	53	55	57	57

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.1	0.2	0.1	-0.1	0.0	0.0	-0.1	-0.6	0.2	0.1	0.0	0.3
0.2	0.4	0.2	-0.2	0.1	0.0	0.0	0.1	-0.6	0.2	0.0	0.2	0.2
0.3	0.4	0.0	0.0	0.0	0.0	0.1	-0.1	-0.7	0.0	-0.1	-0.1	0.4
0.4	0.1	0.0	0.0	0.0	0.0	0.2	0.0	-0.6	0.0	-0.1	-0.1	0.0
0.5	0.2	-0.1	0.1	0.0	0.0	0.1	0.0	-0.5	0.0	-0.1	-0.1	-0.1
0.6	-0.1	0.0	0.1	0.0	0.1	0.0	0.0	-0.6	-0.1	-0.2	0.0	0.0
0.7	-0.1	0.1	0.0	0.1	0.1	0.0	0.0	-0.7	0.0	-0.1	-0.2	0.0
0.8	-0.1	0.0	0.0	0.0	0.1	0.0	-0.1	-0.8	0.0	-0.1	-0.1	-0.1
0.9	-0.1	0.1	0.2	0.2	0.0	0.0	0.0	-0.6	0.0	-0.1	-0.1	0.0
Long Term												
Full Simulation Period ^b	0.2	0.0	0.0	0.0	0.0	0.0	0.0	-0.6	0.0	-0.1	-0.1	0.0
Water Year Types ^c												
Wet (32%)	-0.1	0.1	0.0	0.0	0.0	0.1	0.0	-0.6	0.0	-0.1	-0.1	-0.1
Above Normal (16%)	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.7	0.0	0.0	0.0	0.1
Below Normal (13%)	0.1	0.0	0.2	0.0	0.0	0.1	0.1	-0.8	-0.2	-0.1	-0.1	0.0
Dry (24%)	0.5	0.0	0.0	0.0	0.0	0.0	0.0	-0.6	0.1	0.0	0.0	0.1
Critical (15%)	0.3	0.1	0.1	0.0	0.1	0.0	0.1	-0.4	0.0	-0.1	-0.1	0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-3-5. Clear Creek at Igo, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	56	52	49	46	46	47	49	51	53	57	57	56
20%	55	52	48	46	46	47	49	51	52	56	56	55
30%	54	51	47	45	45	47	48	50	52	56	56	54
40%	54	51	47	45	45	46	48	50	52	55	56	54
50%	53	51	47	45	45	46	48	50	51	55	55	54
60%	52	50	46	44	44	46	47	49	51	55	55	53
70%	52	50	46	44	44	46	47	49	51	55	55	53
80%	51	50	46	44	44	45	47	49	50	54	55	52
90%	51	50	46	43	44	45	46	48	50	54	54	52
Long Term												
Full Simulation Period ^b	53	51	47	45	45	46	48	50	51	55	56	54
Water Year Types ^c												
Wet (32%)	50	48	45	44	45	46	47	49	51	55	55	53
Above Normal (16%)	53	51	47	45	45	46	47	49	51	55	55	53
Below Normal (13%)	52	50	46	44	45	46	48	50	51	55	55	54
Dry (24%)	53	51	47	45	45	46	48	50	51	55	56	54
Critical (15%)	55	53	48	46	46	47	49	51	53	56	57	57

Alternative 3

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	56	52	49	46	46	47	49	51	53	57	57	56
20%	55	52	48	46	46	47	49	51	52	56	56	55
30%	54	51	47	45	45	46	48	50	52	55	56	55
40%	54	51	47	45	45	46	48	50	52	55	56	54
50%	53	51	47	45	45	46	48	50	51	55	55	54
60%	52	50	46	44	44	46	47	49	51	55	55	53
70%	52	50	46	44	44	46	47	49	51	55	55	53
80%	51	50	46	44	44	45	47	49	50	54	55	53
90%	51	49	45	44	44	45	46	48	50	54	54	52
Long Term												
Full Simulation Period ^b	53	51	47	45	45	46	48	50	51	55	56	54
Water Year Types ^c												
Wet (32%)	50	48	45	44	45	46	47	49	51	55	55	53
Above Normal (16%)	53	51	47	45	45	46	47	49	51	55	55	53
Below Normal (13%)	52	50	46	44	45	46	48	49	51	55	55	54
Dry (24%)	53	51	47	45	45	46	48	50	51	55	56	54
Critical (15%)	55	52	48	46	46	47	49	51	53	55	57	57

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	-0.1	-0.1
0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	-0.1	-0.1	0.0	0.0
0.3	0.2	0.0	-0.1	0.0	0.0	-0.1	0.0	0.0	-0.1	-0.1	-0.1	0.2
0.4	0.1	0.1	0.0	0.0	0.0	0.0	-0.2	-0.1	0.0	0.0	-0.1	0.0
0.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.0	0.0	-0.1
0.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.2	0.0	0.0	0.0
0.7	0.0	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	-0.1	0.0
0.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.2	0.0	-0.1	-0.1	0.1
0.9	0.0	0.0	-0.1	0.1	-0.1	0.0	0.0	0.1	0.0	-0.1	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	-0.1	-0.1	0.0
Critical (15%)	-0.1	-0.2	-0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-3-6. Clear Creek at Igo, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	56	52	49	46	46	47	49	51	53	57	57	56
20%	55	52	48	46	46	47	49	51	52	56	56	55
30%	54	51	47	45	45	47	48	50	52	56	56	54
40%	54	51	47	45	45	46	48	50	52	55	56	54
50%	53	51	47	45	45	46	48	50	51	55	55	54
60%	52	50	46	44	44	46	47	49	51	55	55	53
70%	52	50	46	44	44	46	47	49	51	55	55	53
80%	51	50	46	44	44	45	47	49	50	54	55	52
90%	51	50	46	43	44	45	46	48	50	54	54	52
Long Term												
Full Simulation Period ^b	53	51	47	45	45	46	48	50	51	55	56	54
Water Year Types ^c												
Wet (32%)	50	48	45	44	45	46	47	49	51	55	55	53
Above Normal (16%)	53	51	47	45	45	46	47	49	51	55	55	53
Below Normal (13%)	52	50	46	44	45	46	48	50	51	55	55	54
Dry (24%)	53	51	47	45	45	46	48	50	51	55	56	54
Critical (15%)	55	53	48	46	46	47	49	51	53	56	57	57

Alternative 5

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	56	53	49	46	46	47	49	50	53	57	57	56
20%	55	52	48	46	46	47	49	50	53	56	57	55
30%	54	51	47	45	45	47	48	49	52	56	56	55
40%	54	51	47	45	45	46	48	49	52	55	56	54
50%	53	51	47	45	45	46	48	49	51	55	55	54
60%	52	50	46	44	45	46	47	49	51	55	55	53
70%	52	50	46	44	44	46	47	48	51	55	55	53
80%	51	50	46	44	44	45	47	48	50	54	55	52
90%	51	50	46	44	44	45	46	47	50	54	54	52
Long Term												
Full Simulation Period ^b	53	51	47	45	45	46	48	49	52	55	56	54
Water Year Types ^c												
Wet (32%)	50	48	45	45	45	46	47	49	51	55	55	53
Above Normal (16%)	54	51	47	45	45	46	47	49	51	55	55	53
Below Normal (13%)	52	50	47	44	45	46	48	49	51	55	55	54
Dry (24%)	54	51	47	45	45	46	48	49	51	55	56	55
Critical (15%)	55	53	48	46	46	47	49	50	54	56	56	57

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.3	0.2	0.0	-0.1	0.0	0.0	0.1	-0.6	0.3	0.1	0.0	0.0
0.2	0.3	0.2	-0.2	0.0	0.0	0.0	0.1	-0.5	0.2	0.0	0.1	0.2
0.3	0.4	0.0	0.0	0.0	0.0	0.1	0.0	-0.6	0.0	0.1	-0.2	0.4
0.4	0.0	0.1	0.0	0.0	0.0	0.2	0.0	-0.7	0.0	-0.1	-0.2	0.1
0.5	0.2	-0.1	0.1	0.0	0.0	0.1	0.0	-0.6	0.0	-0.1	-0.1	-0.2
0.6	-0.4	0.0	0.1	0.0	0.1	0.0	0.0	-0.6	0.0	-0.2	0.0	-0.1
0.7	-0.1	0.1	0.0	0.1	0.1	0.0	0.0	-0.7	0.0	-0.1	-0.2	0.0
0.8	-0.1	0.0	0.0	0.0	0.1	0.0	-0.1	-0.7	0.0	-0.1	-0.1	-0.1
0.9	-0.1	0.1	0.2	0.2	0.0	0.0	0.0	-0.8	0.0	-0.1	0.0	0.0
Long Term												
Full Simulation Period ^b	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.6	0.1	0.0	-0.1	0.0
Water Year Types ^c												
Wet (32%)	-0.1	0.1	0.0	0.0	0.0	0.1	0.0	-0.6	0.1	0.0	-0.1	-0.2
Above Normal (16%)	0.2	0.1	0.0	0.1	0.0	0.0	-0.1	-0.8	0.0	0.0	0.0	0.1
Below Normal (13%)	0.0	0.0	0.2	0.0	0.0	0.1	0.1	-0.6	-0.1	-0.1	0.0	0.1
Dry (24%)	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.6	0.1	0.0	0.0	0.1
Critical (15%)	0.2	0.1	0.1	0.0	0.1	0.0	0.1	-0.1	0.4	0.1	-0.3	-0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


B.4. Clear Creek at Mouth Temperature

Figure B-4-1. Clear Creek at mouth, October

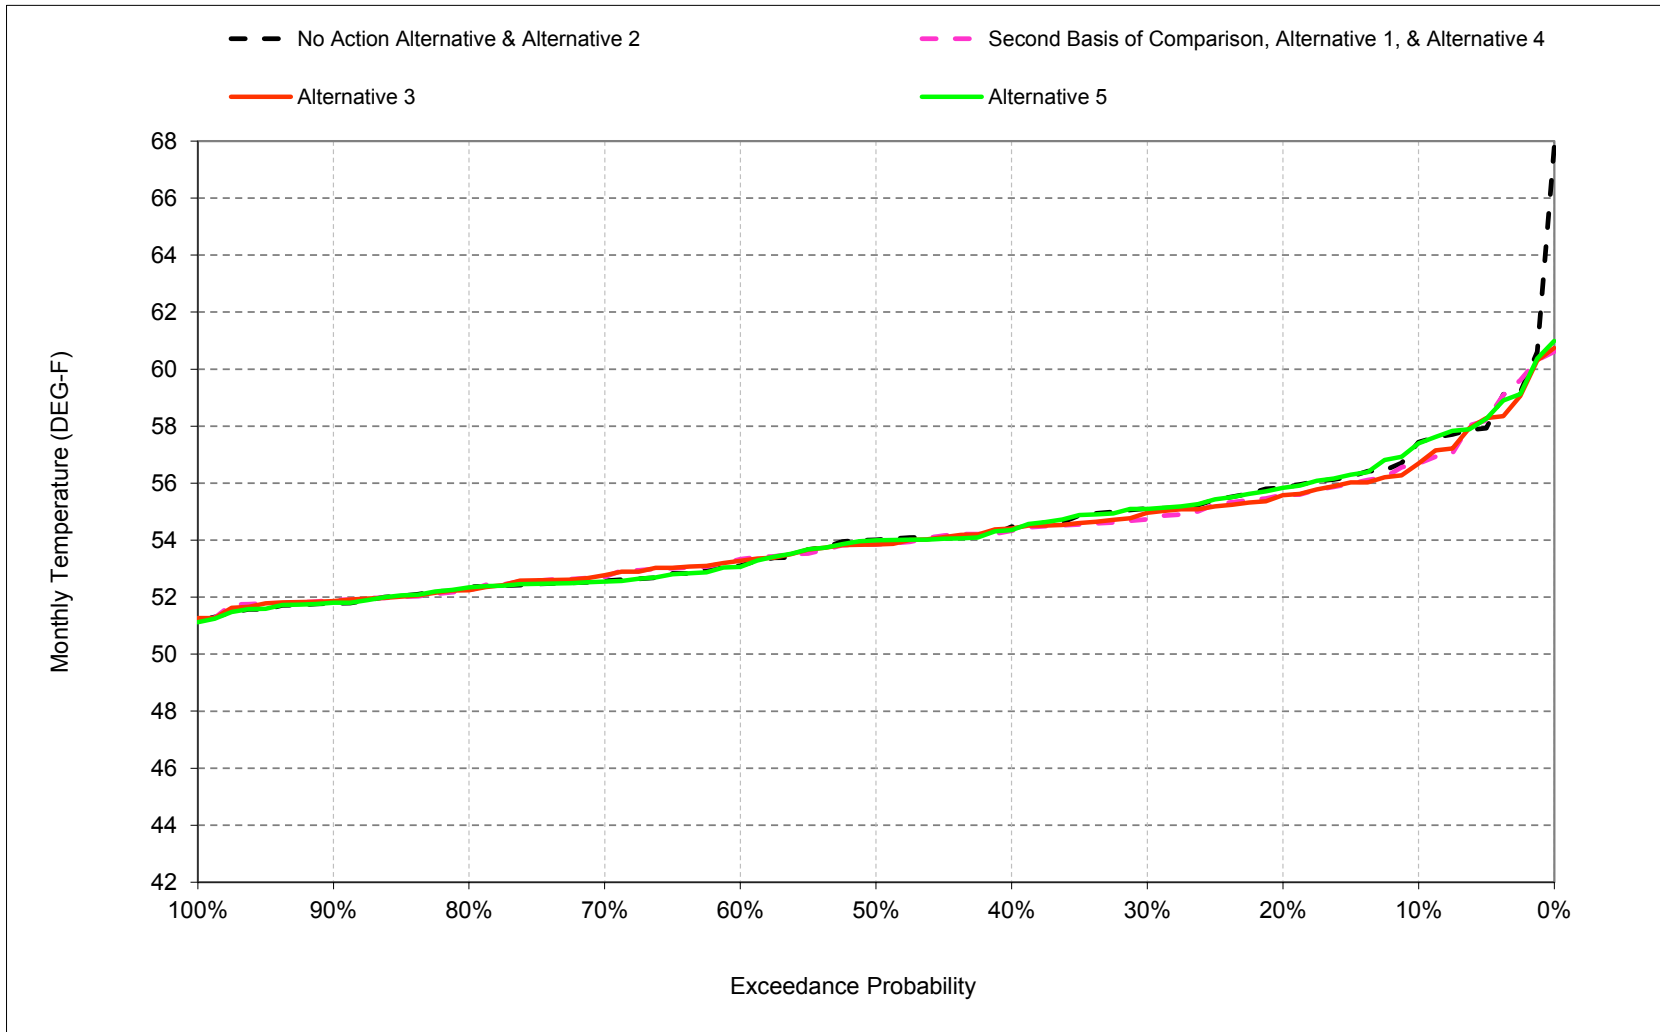


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-4-2. Clear Creek at mouth, November

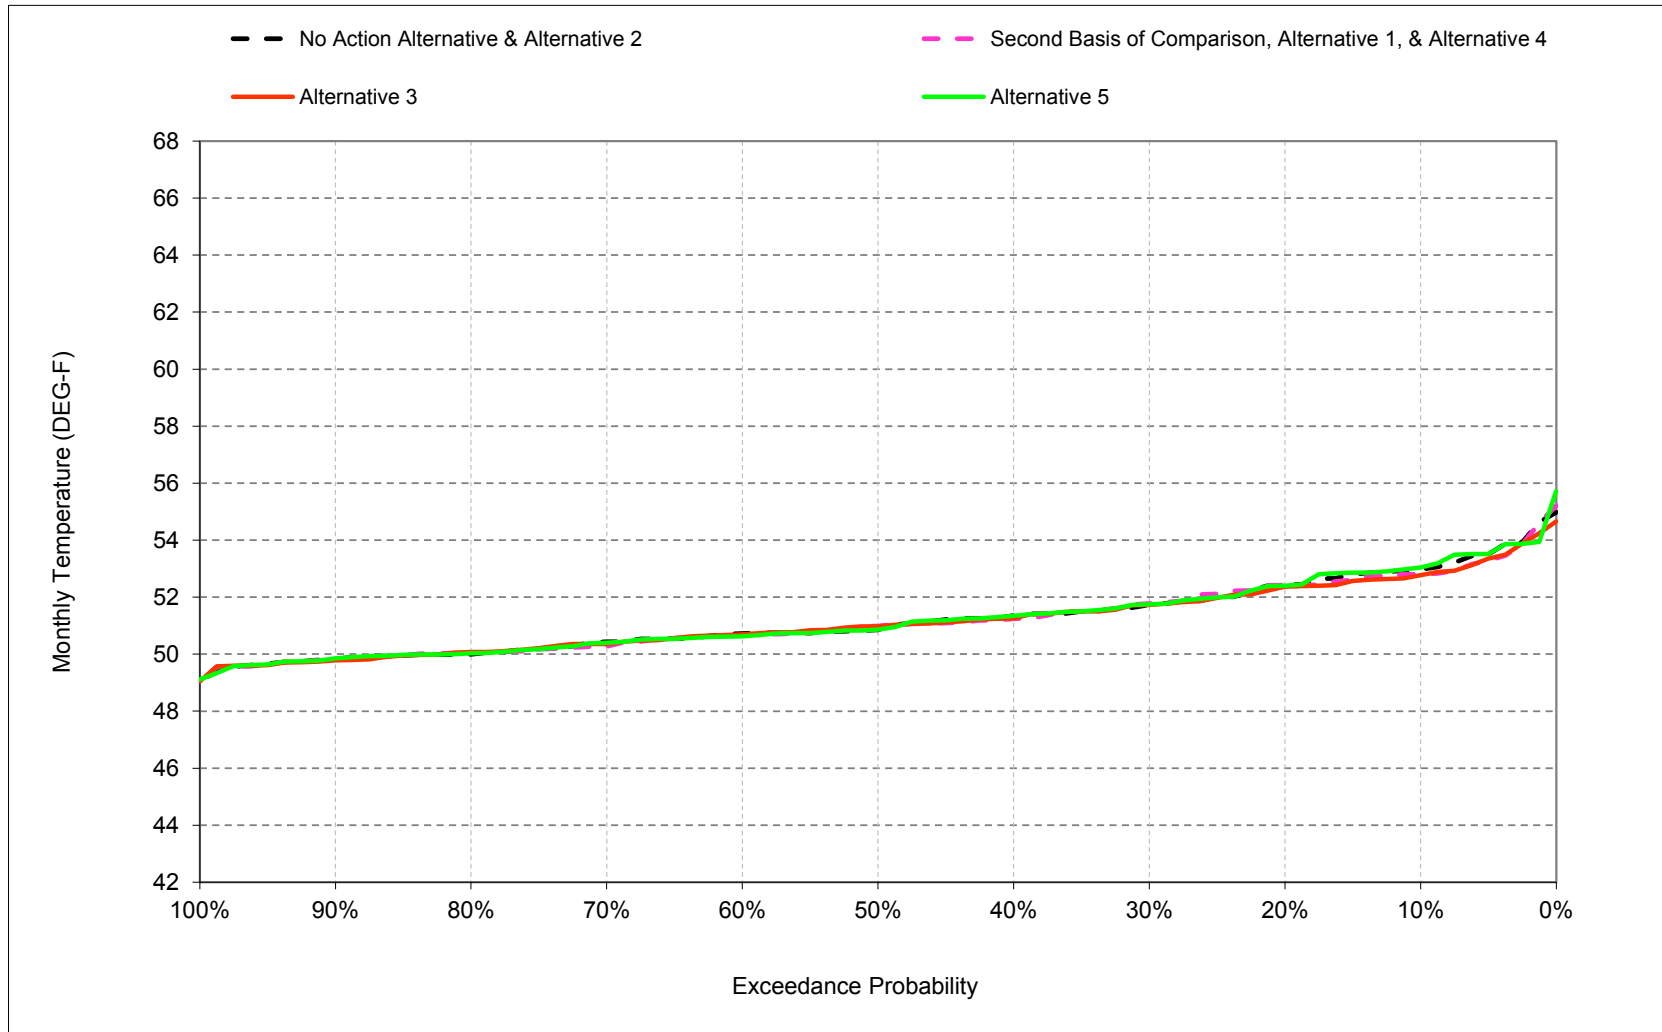


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-4-3. Clear Creek at mouth, December

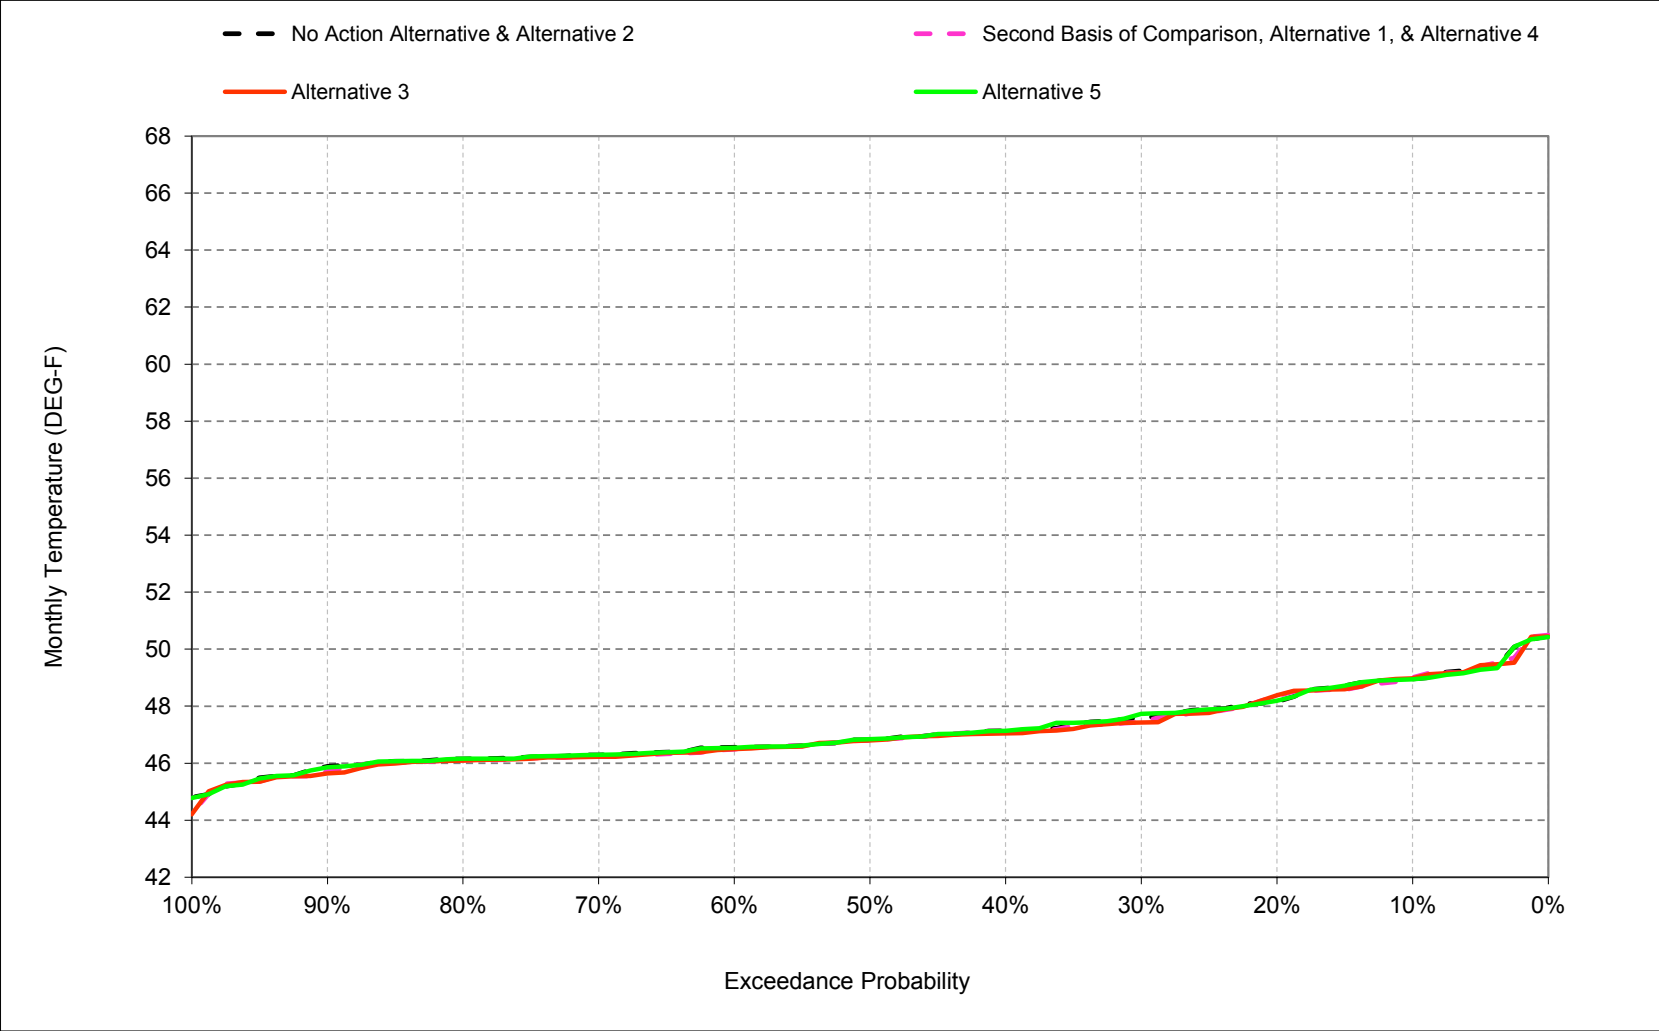


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-4-4. Clear Creek at mouth, January

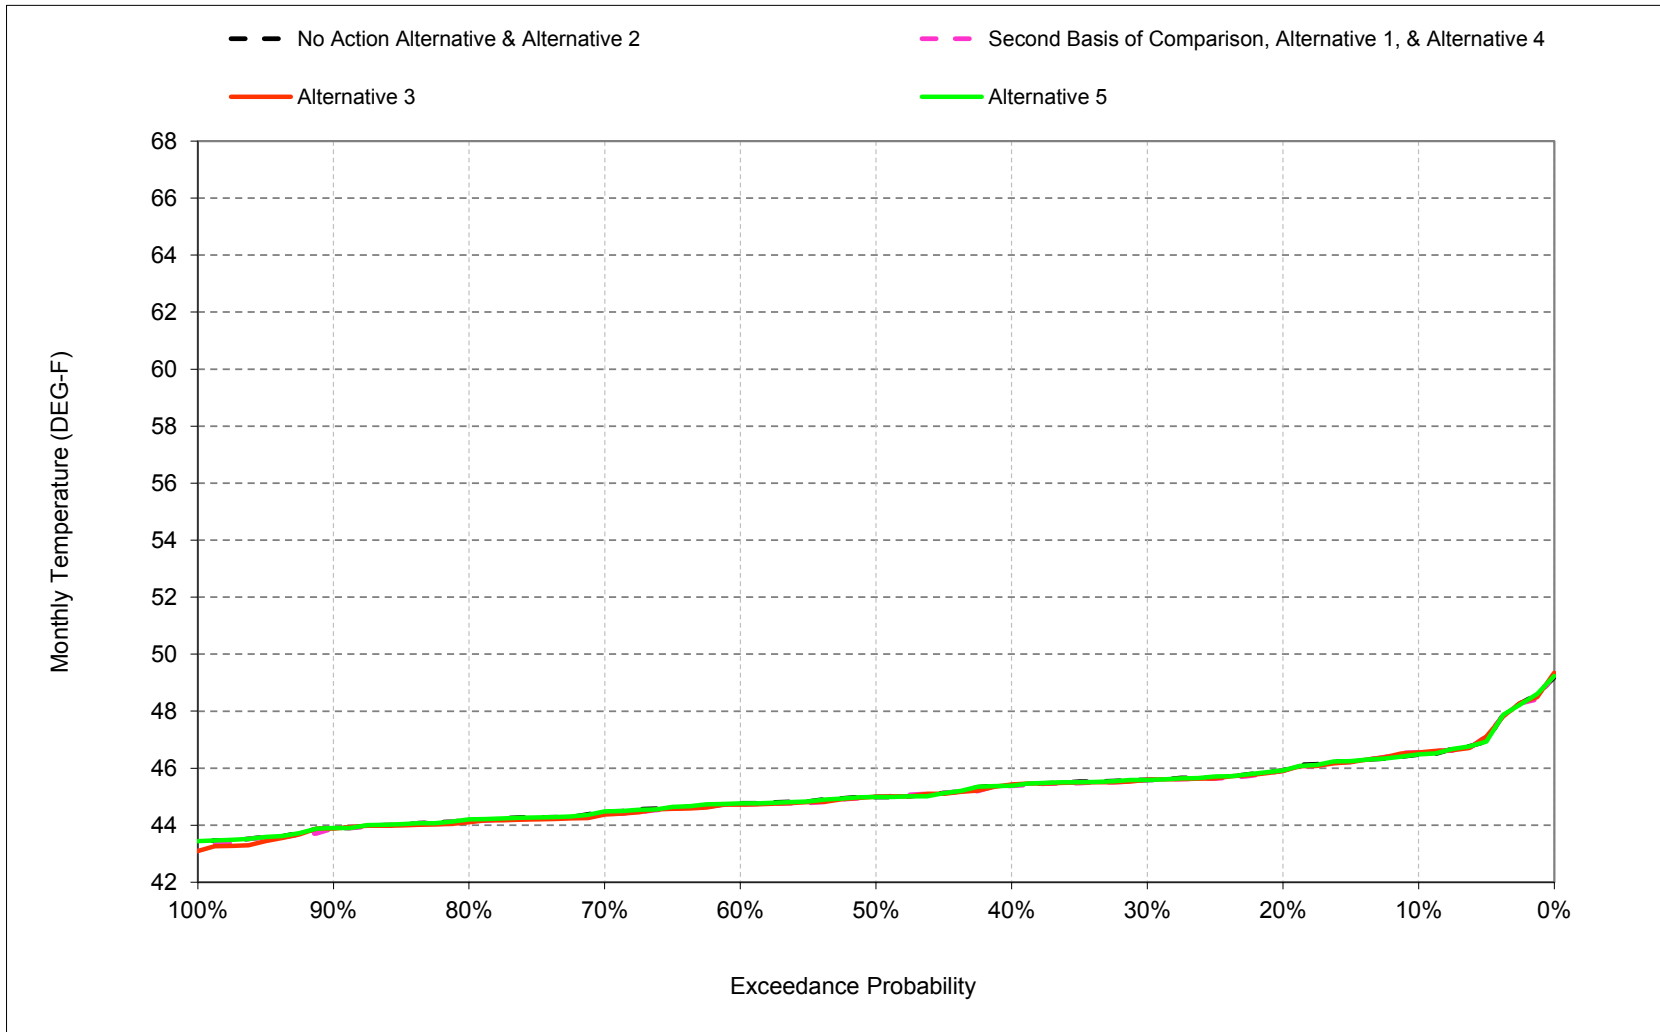


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-4-5. Clear Creek at mouth, February

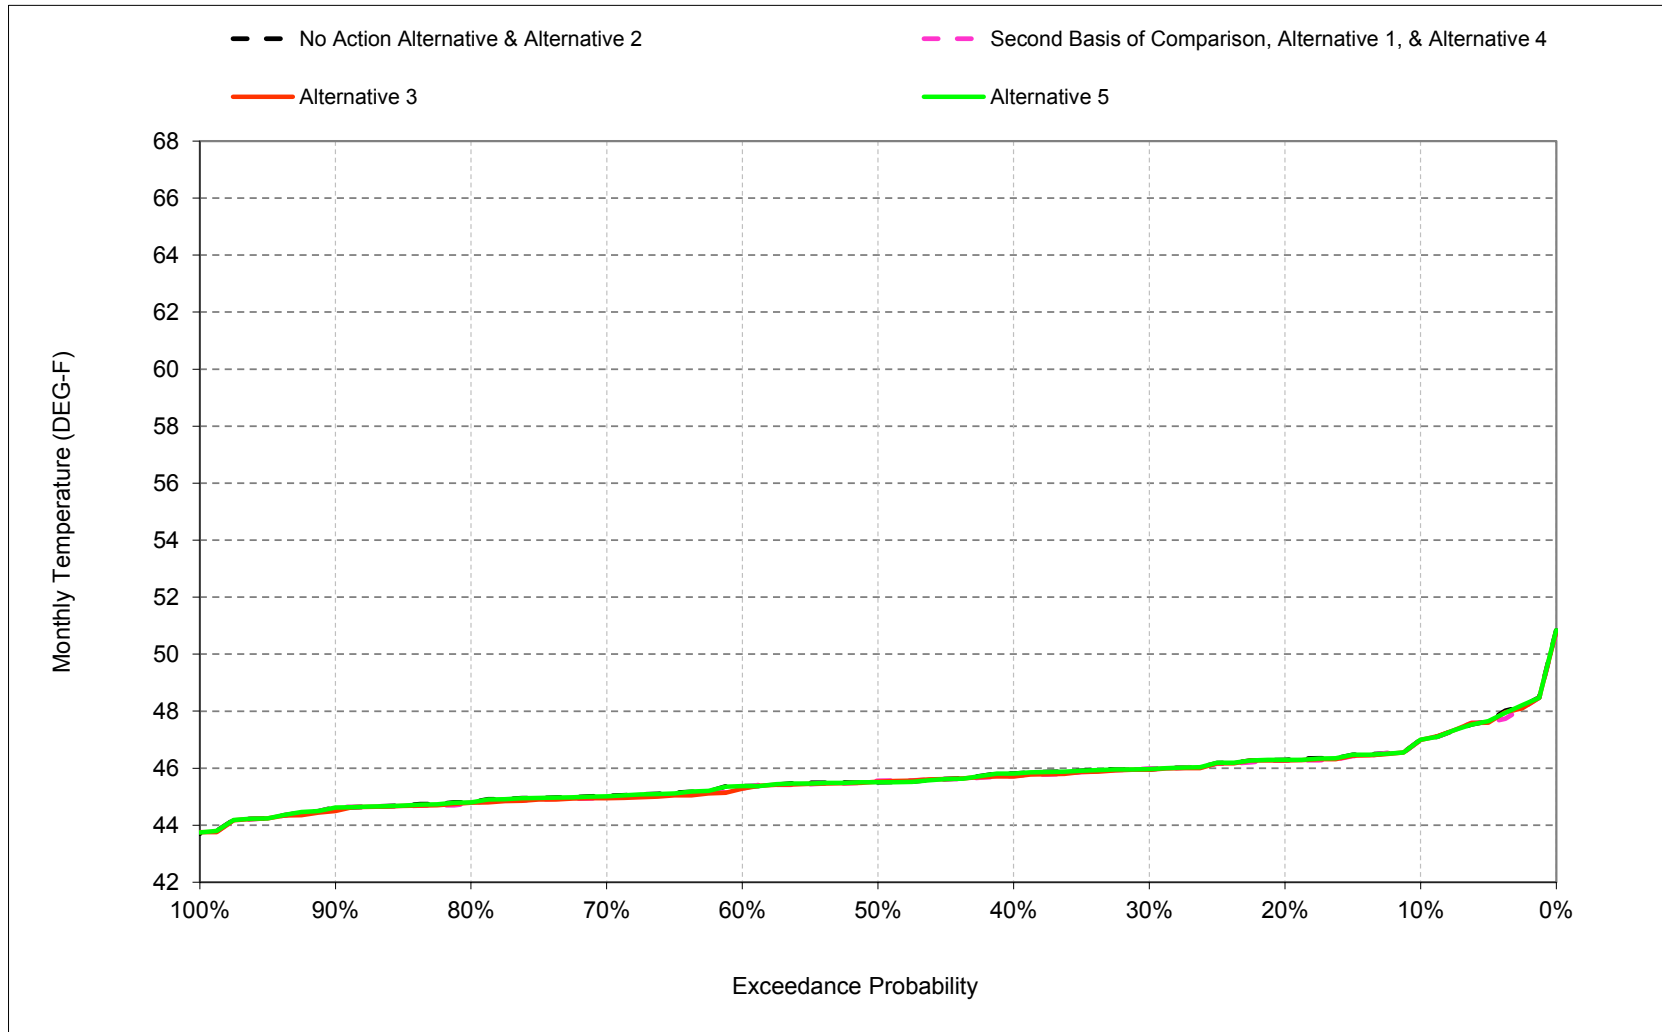


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-4-6. Clear Creek at mouth, March

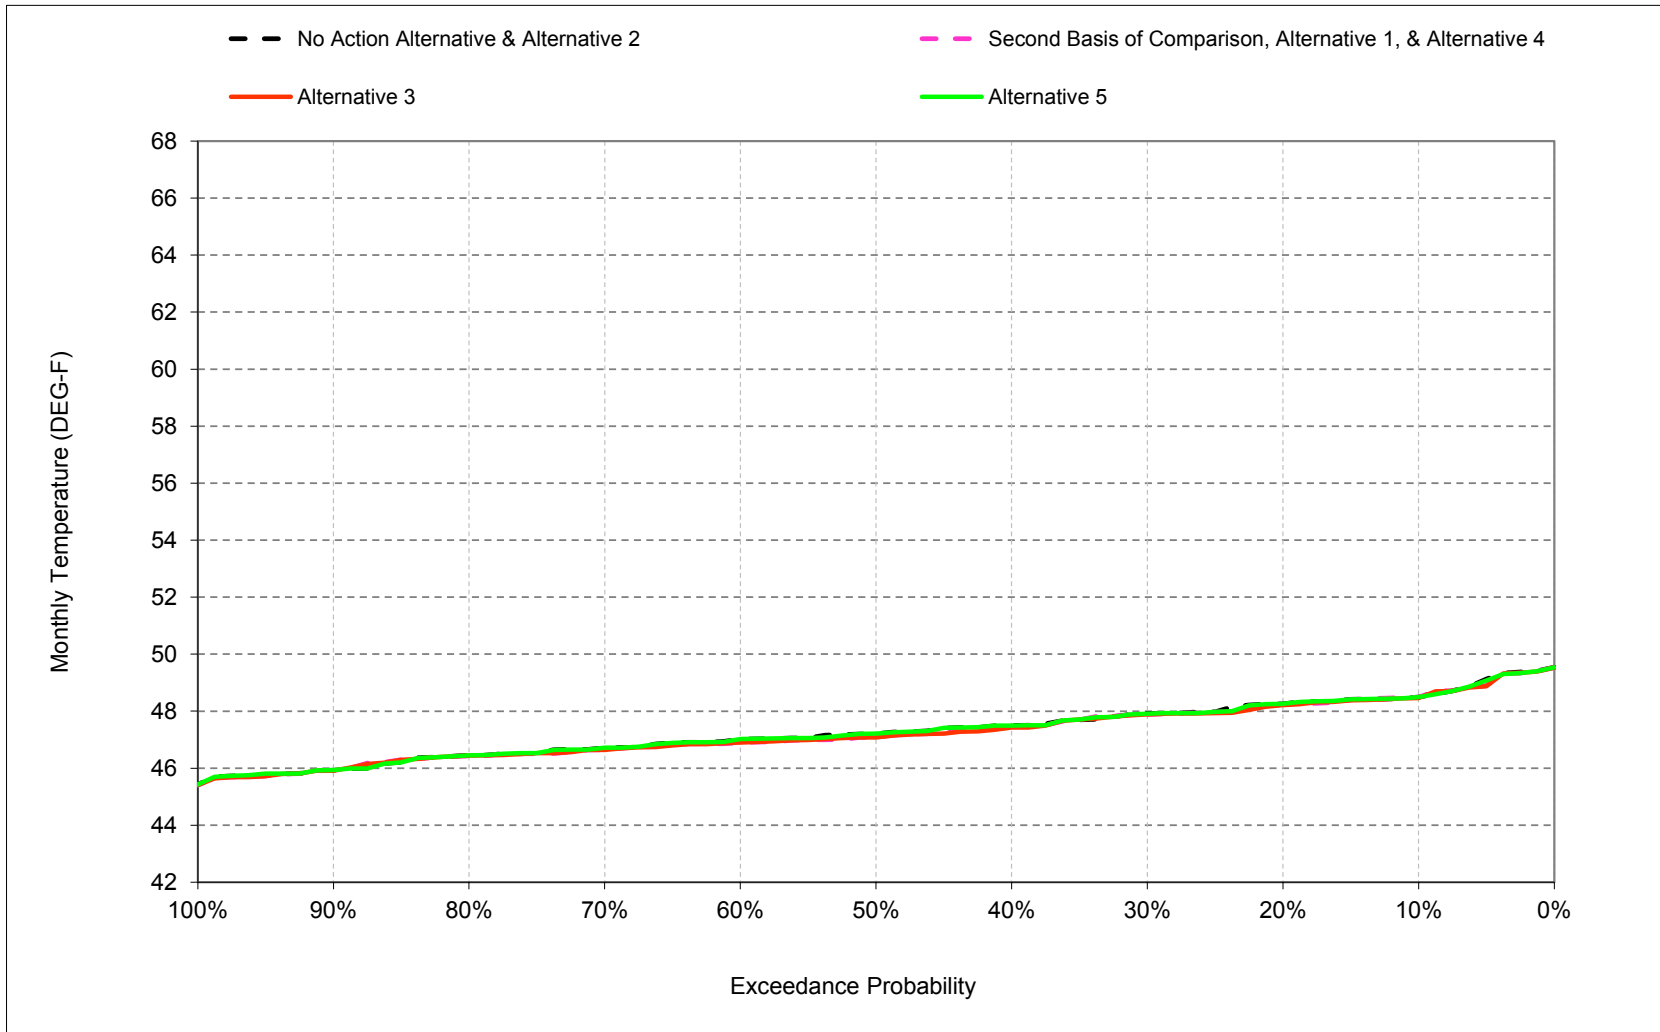


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-4-7. Clear Creek at mouth, April

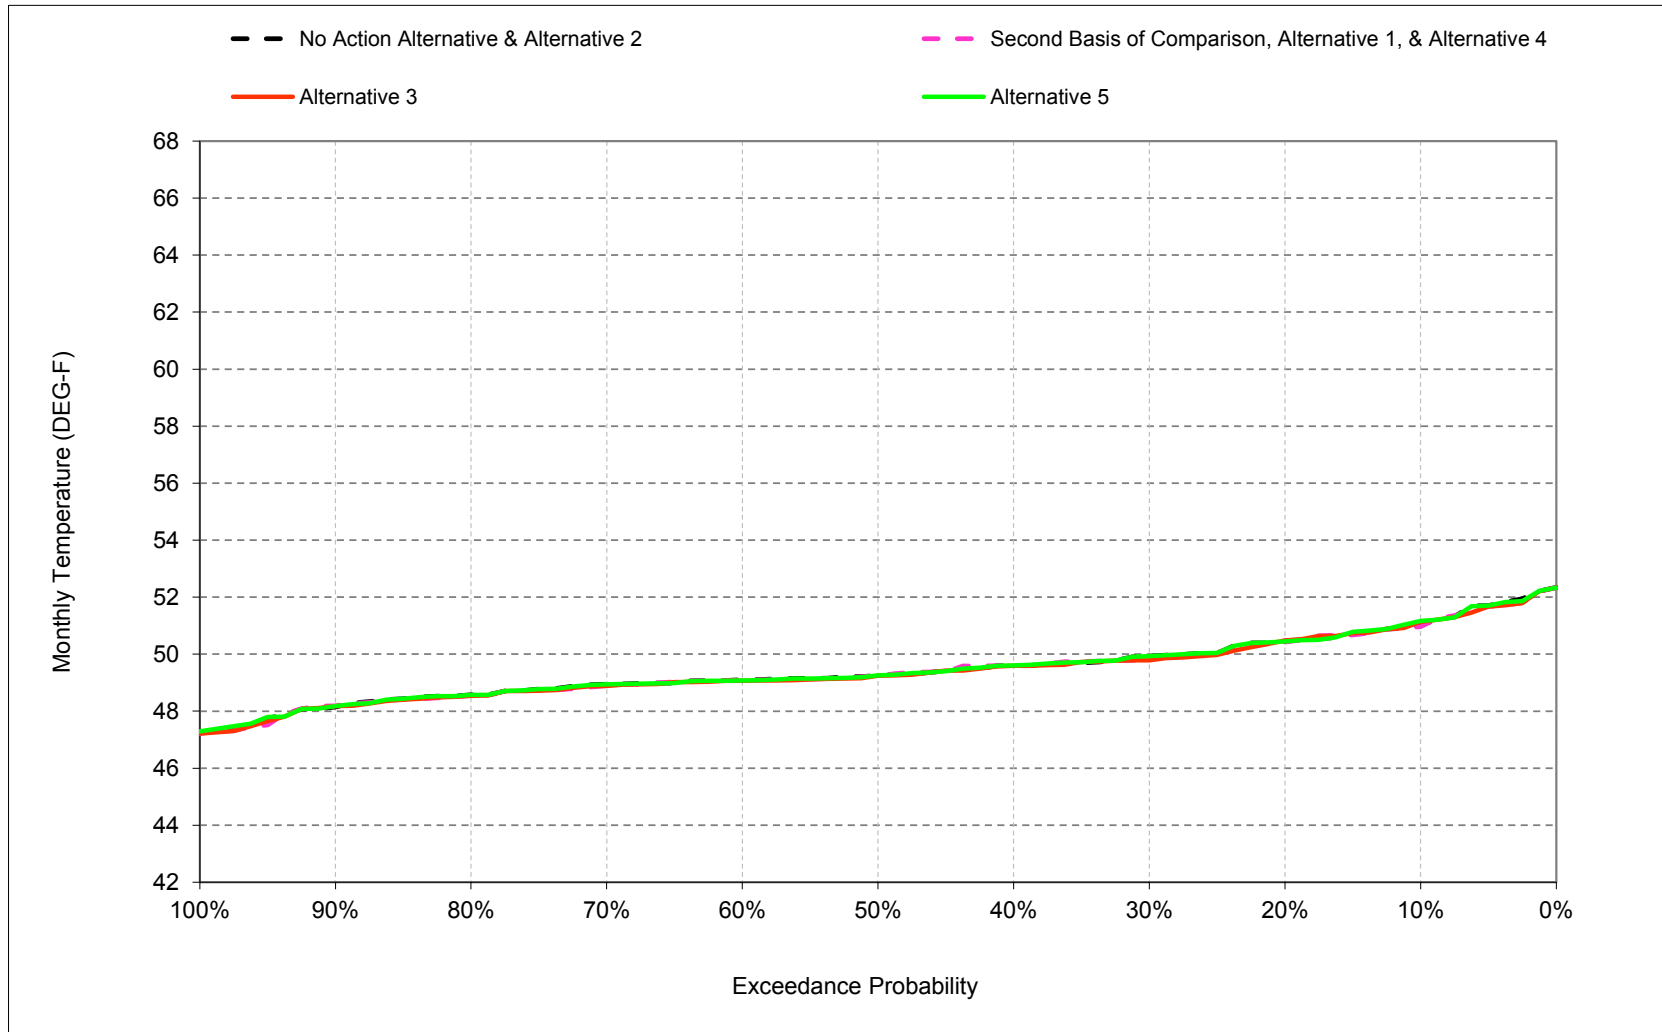


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-4-8. Clear Creek at mouth, May

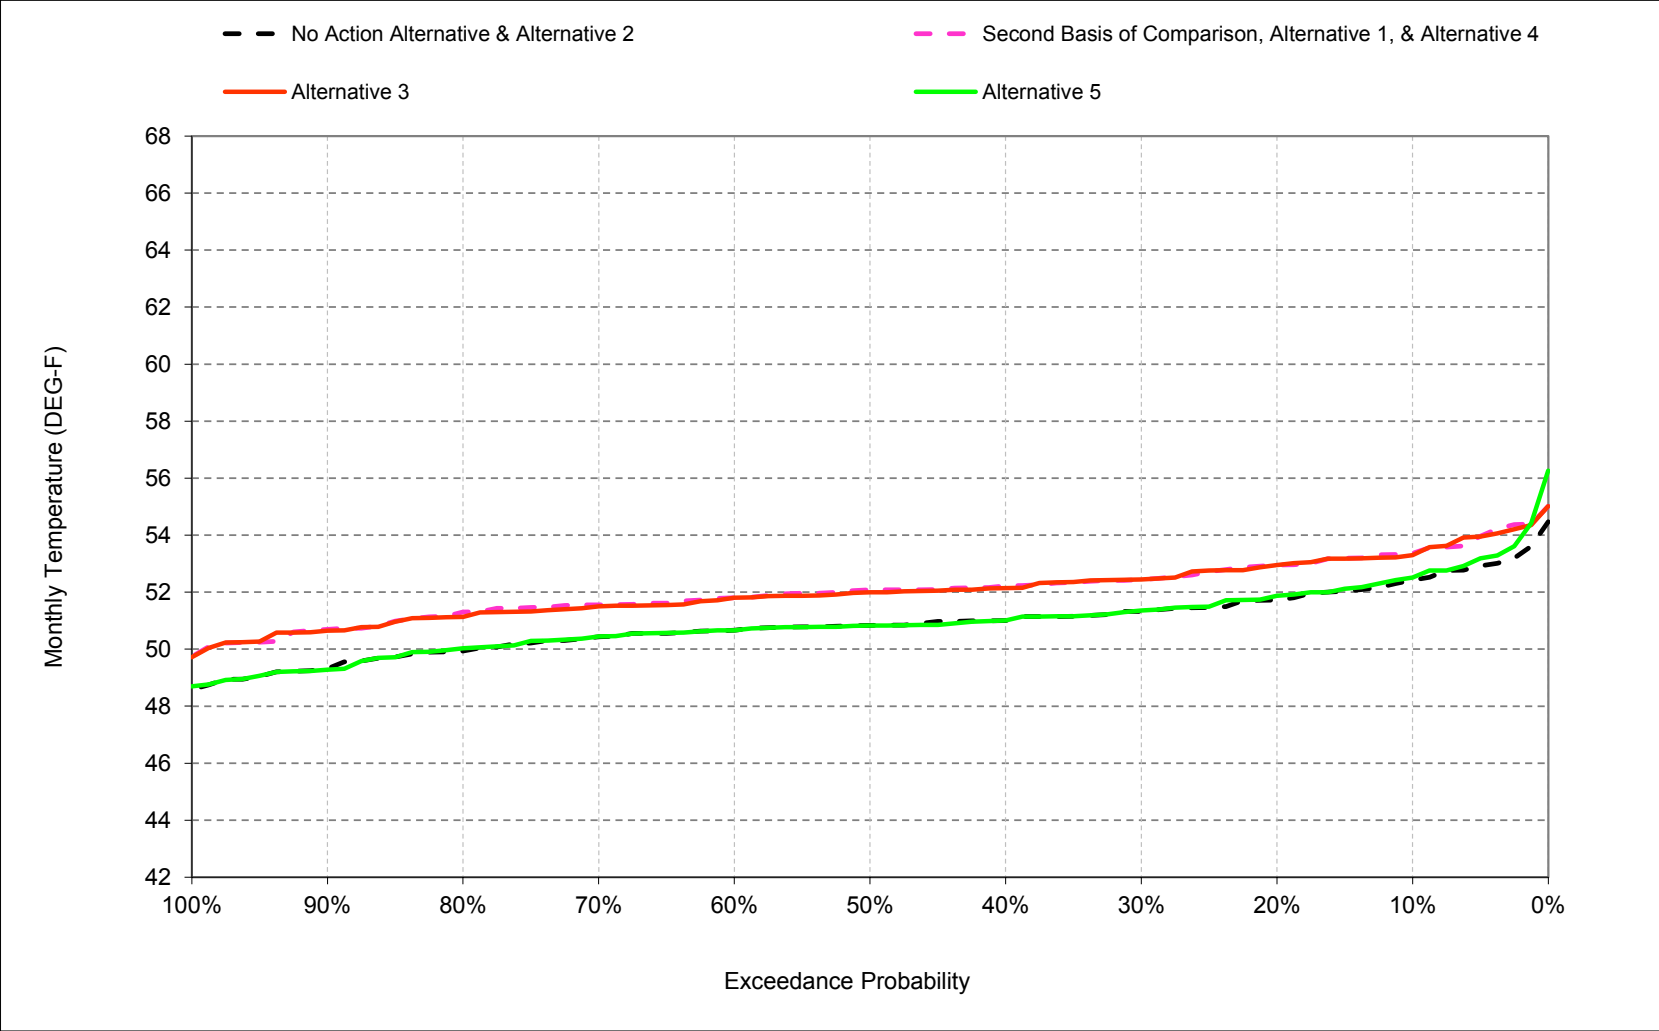


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-4-9. Clear Creek at mouth, June

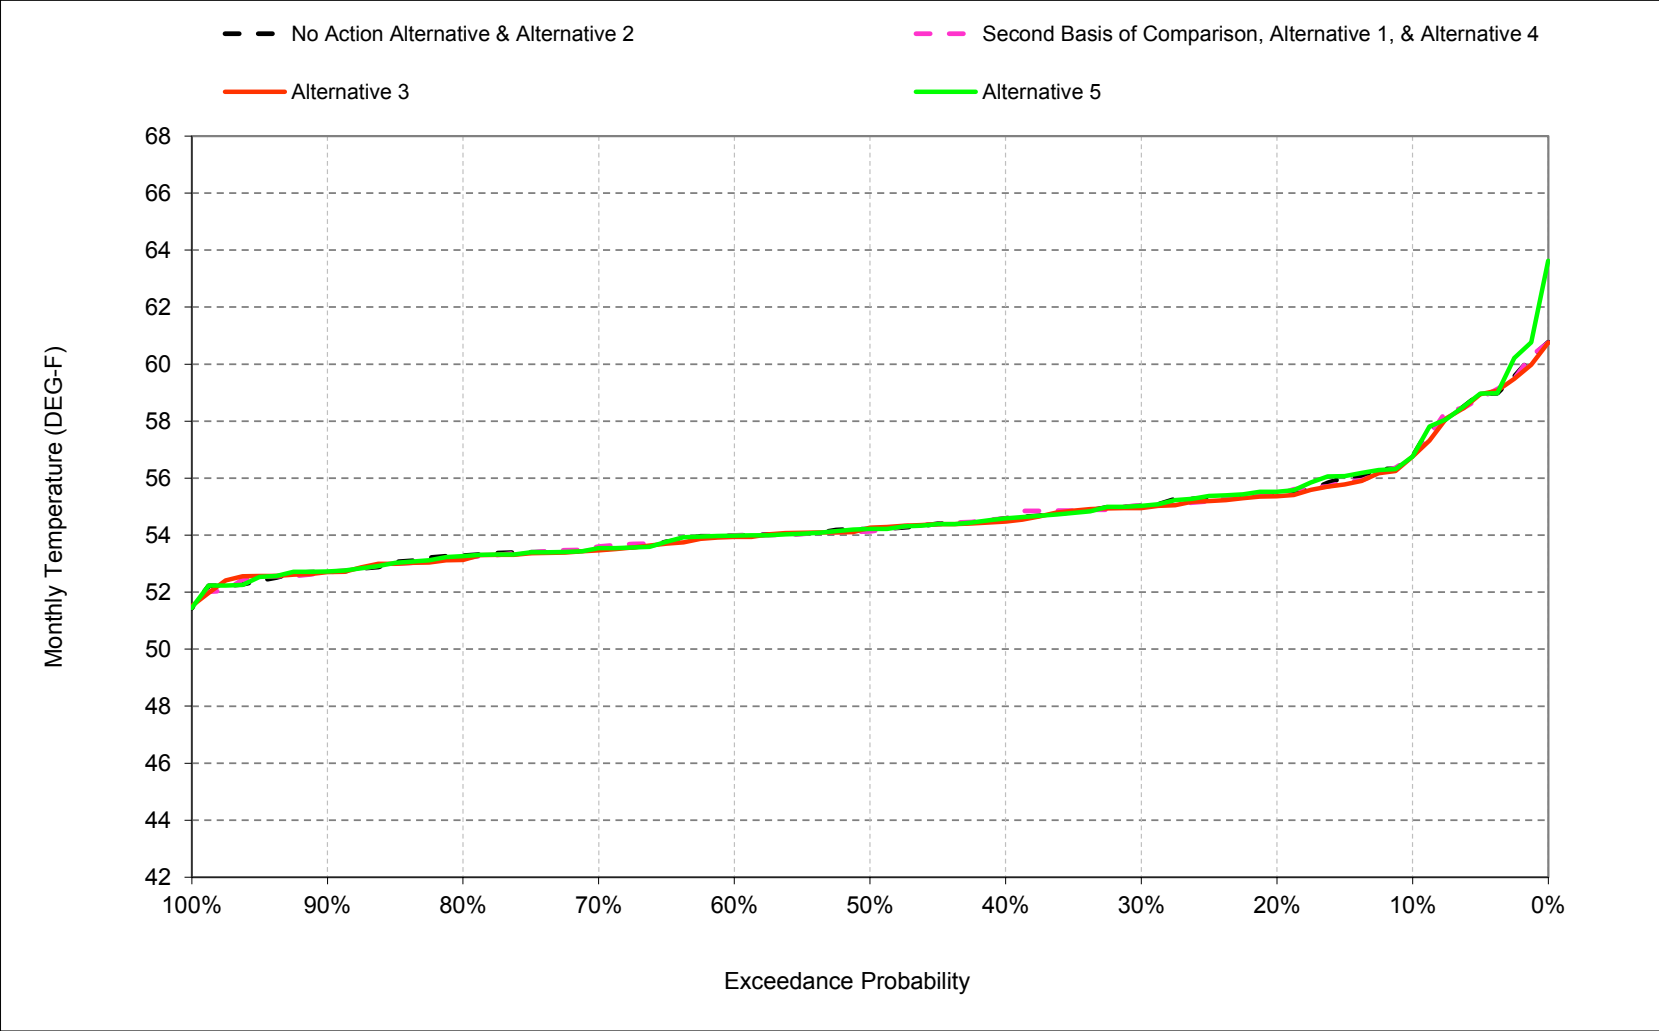


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-4-10. Clear Creek at mouth, July

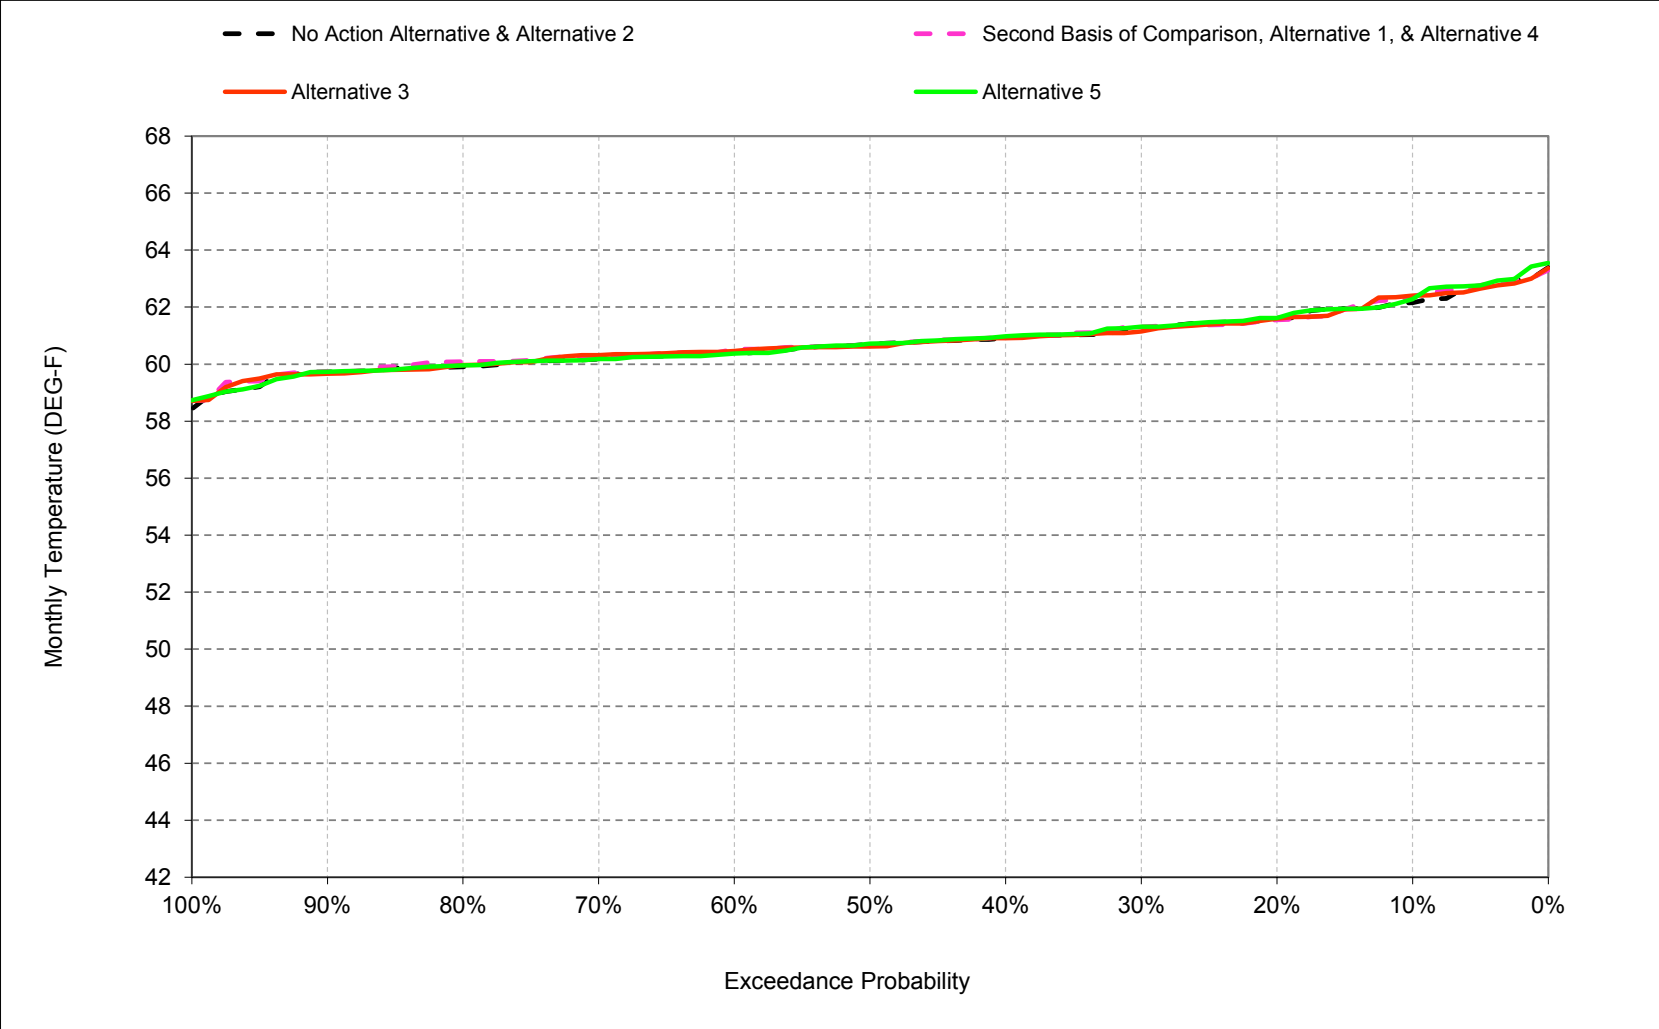


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-4-11. Clear Creek at mouth, August

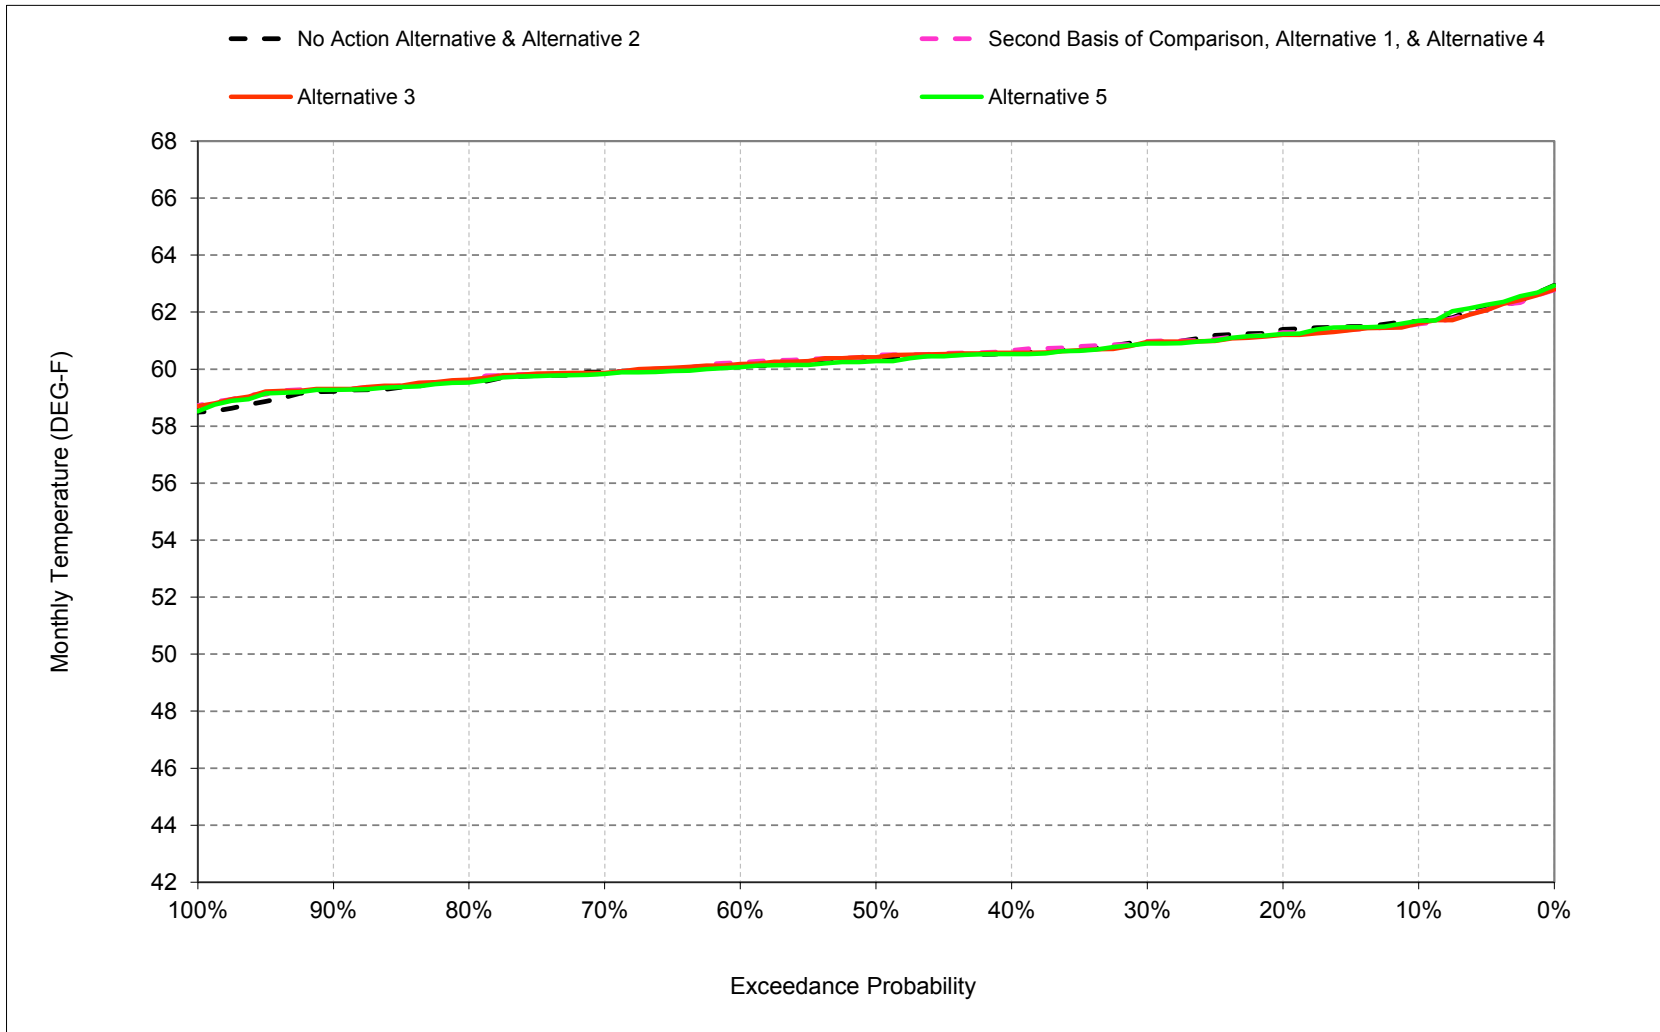

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-4-12. Clear Creek at mouth, September

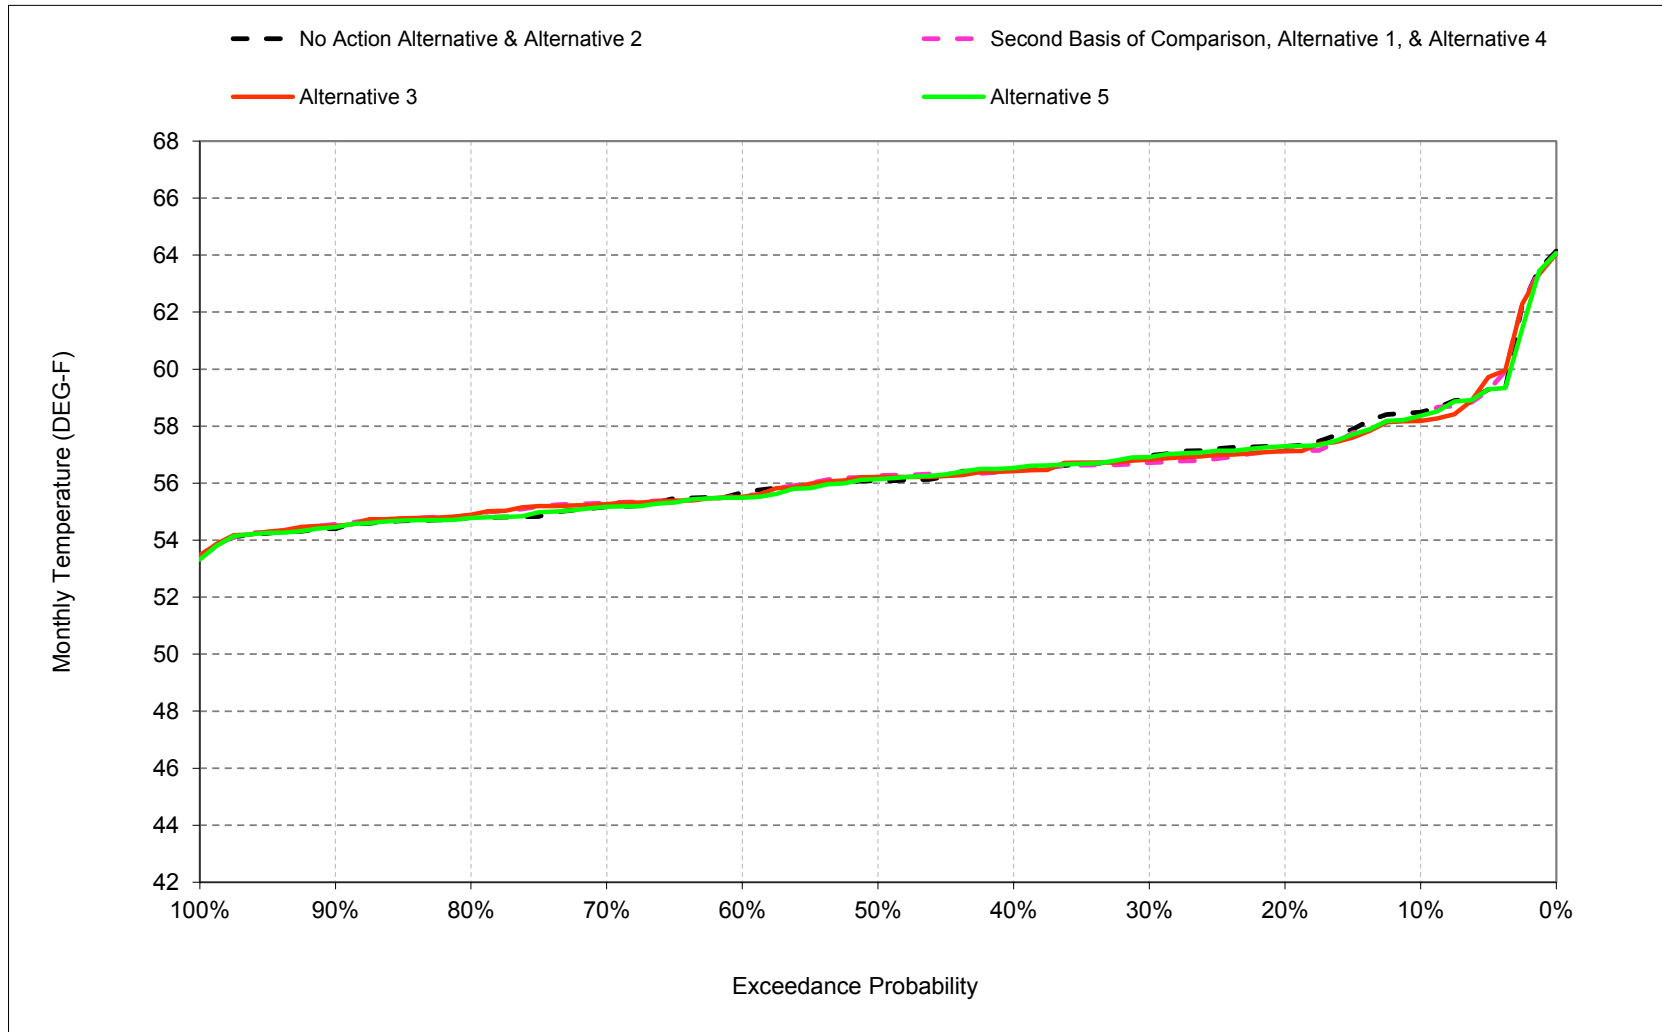

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-4-1. Clear Creek at mouth, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	57	53	49	46	47	48	51	52	57	62	62	58
20%	56	52	48	46	46	48	50	52	55	62	61	57
30%	55	52	48	46	46	48	50	51	55	61	61	57
40%	54	51	47	45	46	47	50	51	55	61	61	56
50%	54	51	47	45	46	47	49	51	54	61	60	56
60%	53	51	47	45	45	47	49	51	54	60	60	56
70%	53	50	46	44	45	47	49	50	53	60	60	55
80%	52	50	46	44	45	46	49	50	53	60	60	55
90%	52	50	46	44	45	46	48	49	53	60	59	54
Long Term												
Full Simulation Period ^b	54	51	47	45	46	47	49	51	55	61	60	56
Water Year Types ^c												
Wet (32%)	51	49	45	45	45	47	49	51	54	61	60	55
Above Normal (16%)	54	51	47	45	45	47	49	51	54	60	60	55
Below Normal (13%)	53	50	47	45	45	47	50	50	54	61	60	56
Dry (24%)	55	51	47	45	46	48	50	51	55	61	61	57
Critical (15%)	56	53	48	46	47	49	51	52	58	61	61	60

Alternative 1												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	57	53	49	47	47	48	51	53	57	62	62	58
20%	56	52	48	46	46	48	50	53	55	62	61	57
30%	55	52	47	46	46	48	50	52	55	61	61	57
40%	54	51	47	45	46	47	50	52	55	61	61	56
50%	54	51	47	45	46	47	49	52	54	61	60	56
60%	53	51	46	45	45	47	49	52	54	60	60	56
70%	53	50	46	44	45	47	49	52	54	60	60	55
80%	52	50	46	44	45	46	49	51	53	60	60	55
90%	52	50	46	44	44	46	48	51	53	60	59	55
Long Term												
Full Simulation Period ^b	54	51	47	45	46	47	49	52	55	61	60	56
Water Year Types ^c												
Wet (32%)	51	49	45	45	45	47	49	52	54	61	60	55
Above Normal (16%)	54	51	47	45	45	47	49	52	54	61	60	55
Below Normal (13%)	53	50	47	45	45	47	50	52	54	61	60	56
Dry (24%)	54	51	47	45	46	48	50	52	54	61	61	57
Critical (15%)	56	53	48	46	47	49	51	53	58	61	61	60

Alternative 1 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.7	-0.2	0.0	0.1	0.0	0.0	-0.1	0.9	0.0	0.2	-0.1	-0.2
0.2	-0.2	0.0	0.2	0.0	0.0	0.0	0.0	1.2	-0.1	-0.1	-0.1	-0.2
0.3	-0.4	0.0	-0.2	0.0	0.0	0.0	-0.1	1.1	0.0	0.1	0.0	-0.2
0.4	-0.1	-0.1	0.0	0.0	-0.1	-0.1	0.0	1.2	0.0	0.0	0.1	0.0
0.5	-0.2	0.1	0.0	0.0	0.0	-0.1	0.0	1.2	-0.1	0.0	0.2	0.2
0.6	0.2	0.0	-0.1	0.0	-0.2	-0.1	0.0	1.1	0.0	0.1	0.1	-0.1
0.7	0.1	-0.2	0.0	-0.1	-0.1	0.0	-0.1	1.2	0.1	0.1	-0.1	0.1
0.8	-0.1	0.1	0.0	0.0	-0.1	0.0	0.0	1.3	-0.1	0.2	0.0	0.1
0.9	0.1	0.0	-0.2	-0.1	0.0	0.0	0.1	1.4	-0.1	0.0	0.1	0.1
Long Term												
Full Simulation Period ^b	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	1.2	0.0	0.1	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.1	-0.1	0.0	0.0	0.0	0.0	0.0	1.2	0.0	0.1	0.1	0.2
Above Normal (16%)	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	1.3	0.0	0.0	0.0	-0.1
Below Normal (13%)	-0.1	0.0	-0.2	0.0	0.0	-0.1	-0.1	1.3	0.2	0.1	0.1	0.0
Dry (24%)	-0.4	0.0	0.0	0.0	0.0	0.0	0.0	1.2	-0.1	0.0	0.0	-0.1
Critical (15%)	-0.2	-0.1	-0.1	0.0	-0.1	0.0	-0.1	0.9	0.0	0.1	0.1	-0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-4-2. Clear Creek at mouth, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	57	53	49	46	47	48	51	52	57	62	62	58
20%	56	52	48	46	46	48	50	52	55	62	61	57
30%	55	52	48	46	46	48	50	51	55	61	61	57
40%	54	51	47	45	46	47	50	51	55	61	61	56
50%	54	51	47	45	46	47	49	51	54	61	60	56
60%	53	51	47	45	45	47	49	51	54	60	60	56
70%	53	50	46	44	45	47	49	50	53	60	60	55
80%	52	50	46	44	45	46	49	50	53	60	60	55
90%	52	50	46	44	45	46	48	49	53	60	59	54
Long Term												
Full Simulation Period ^b	54	51	47	45	46	47	49	51	55	61	60	56
Water Year Types ^c												
Wet (32%)	51	49	45	45	45	47	49	51	54	61	60	55
Above Normal (16%)	54	51	47	45	45	47	49	51	54	60	60	55
Below Normal (13%)	53	50	47	45	45	47	50	50	54	61	60	56
Dry (24%)	55	51	47	45	46	48	50	51	55	61	61	57
Critical (15%)	56	53	48	46	47	49	51	52	58	61	61	60

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	57	53	49	47	47	48	51	53	57	62	62	58
20%	56	52	48	46	46	48	50	53	55	62	61	57
30%	55	52	47	46	46	48	50	52	55	61	61	57
40%	54	51	47	45	46	47	50	52	54	61	61	56
50%	54	51	47	45	46	47	49	52	54	61	60	56
60%	53	51	46	45	45	47	49	52	54	60	60	56
70%	53	50	46	44	45	47	49	51	53	60	60	55
80%	52	50	46	44	45	46	49	51	53	60	60	55
90%	52	50	46	44	44	46	48	51	53	60	59	55
Long Term												
Full Simulation Period ^b	54	51	47	45	46	47	49	52	55	61	60	56
Water Year Types ^c												
Wet (32%)	51	49	45	45	45	47	49	52	54	61	60	55
Above Normal (16%)	54	51	47	45	45	47	49	52	54	61	60	55
Below Normal (13%)	53	51	47	45	45	47	50	52	54	61	60	56
Dry (24%)	54	51	47	45	46	48	50	52	54	61	61	57
Critical (15%)	56	53	48	46	47	49	51	53	58	61	61	60

Alternative 3 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.8	-0.2	0.0	0.1	0.0	0.0	0.1	0.9	0.0	0.2	-0.1	-0.3
0.2	-0.3	-0.1	0.2	0.0	0.0	0.0	0.0	1.2	-0.1	0.0	-0.2	-0.2
0.3	-0.1	0.0	-0.2	0.0	0.0	0.0	-0.1	1.1	-0.1	-0.1	0.0	-0.1
0.4	-0.1	-0.1	-0.1	0.0	-0.1	-0.1	0.0	1.1	-0.1	0.0	0.0	-0.1
0.5	-0.2	0.1	0.0	0.0	0.0	-0.1	0.0	1.2	0.0	-0.1	0.1	0.1
0.6	0.2	0.0	-0.1	0.0	-0.2	-0.1	0.0	1.1	-0.1	0.1	0.1	-0.1
0.7	0.2	-0.1	-0.1	-0.1	-0.1	0.0	-0.1	1.1	0.0	0.2	0.0	0.1
0.8	-0.1	0.1	-0.1	-0.1	0.0	0.0	0.0	1.2	-0.1	0.0	0.1	0.1
0.9	0.1	0.0	-0.2	0.0	-0.1	0.0	0.0	1.3	-0.1	-0.1	0.1	0.1
Long Term												
Full Simulation Period ^b	-0.1	-0.1	-0.1	0.0	0.0	-0.1	0.0	1.1	0.0	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.1	0.0	0.0	0.0	0.0	-0.1	0.0	1.2	0.0	0.0	0.0	0.2
Above Normal (16%)	-0.1	0.0	-0.1	0.0	0.0	0.0	0.0	1.2	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	-0.2	0.0	-0.1	-0.1	-0.1	1.3	0.1	0.1	0.1	-0.1
Dry (24%)	-0.4	0.0	0.0	0.0	0.0	0.0	-0.1	1.1	-0.1	0.0	-0.1	-0.1
Critical (15%)	-0.4	-0.3	-0.2	-0.1	-0.1	-0.1	-0.1	0.8	-0.1	0.0	0.1	-0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-4-3. Clear Creek at mouth, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	57	53	49	46	47	48	51	52	57	62	62	58
20%	56	52	48	46	46	48	50	52	55	62	61	57
30%	55	52	48	46	46	48	50	51	55	61	61	57
40%	54	51	47	45	46	47	50	51	55	61	61	56
50%	54	51	47	45	46	47	49	51	54	61	60	56
60%	53	51	47	45	45	47	49	51	54	60	60	56
70%	53	50	46	44	45	47	49	50	53	60	60	55
80%	52	50	46	44	45	46	49	50	53	60	60	55
90%	52	50	46	44	45	46	48	49	53	60	59	54
Long Term												
Full Simulation Period ^b	54	51	47	45	46	47	49	51	55	61	60	56
Water Year Types ^c												
Wet (32%)	51	49	45	45	45	47	49	51	54	61	60	55
Above Normal (16%)	54	51	47	45	45	47	49	51	54	60	60	55
Below Normal (13%)	53	50	47	45	45	47	50	50	54	61	60	56
Dry (24%)	55	51	47	45	46	48	50	51	55	61	61	57
Critical (15%)	56	53	48	46	47	49	51	52	58	61	61	60

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	57	53	49	46	47	48	51	53	57	62	62	58
20%	56	52	48	46	46	48	50	52	56	62	61	57
30%	55	52	48	46	46	48	50	51	55	61	61	57
40%	54	51	47	45	46	47	50	51	55	61	61	57
50%	54	51	47	45	46	47	49	51	54	61	60	56
60%	53	51	47	45	45	47	49	51	54	60	60	56
70%	53	50	46	44	45	47	49	50	53	60	60	55
80%	52	50	46	44	45	46	49	50	53	60	60	55
90%	52	50	46	44	45	46	48	49	53	60	59	54
Long Term												
Full Simulation Period ^b	54	51	47	45	46	47	49	51	55	61	60	56
Water Year Types ^c												
Wet (32%)	51	49	45	45	45	47	49	51	54	61	60	55
Above Normal (16%)	55	51	47	45	45	47	49	50	54	60	60	55
Below Normal (13%)	53	50	47	45	45	47	50	51	54	61	60	56
Dry (24%)	55	51	47	45	46	48	50	51	54	61	61	57
Critical (15%)	56	53	48	46	47	49	51	53	58	61	61	59

Alternative 5 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.0	0.1	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.1	0.0	-0.1
0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-0.1	0.0
0.3	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0
0.4	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.1
0.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
0.6	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.2
0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
0.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0
0.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0
Long Term												
Full Simulation Period ^b	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.1	0.0	0.1	0.1
Dry (24%)	-0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3	0.3	0.2	-0.2	-0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-4-4. Clear Creek at mouth, Monthly Temperature

Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	57	53	49	47	47	48	51	53	57	62	62	58
20%	56	52	48	46	46	48	50	53	55	62	61	57
30%	55	52	47	46	46	48	50	52	55	61	61	57
40%	54	51	47	45	46	47	50	52	55	61	61	56
50%	54	51	47	45	46	47	49	52	54	61	60	56
60%	53	51	46	45	45	47	49	52	54	60	60	56
70%	53	50	46	44	45	47	49	52	54	60	60	55
80%	52	50	46	44	45	46	49	51	53	60	60	55
90%	52	50	46	44	44	46	48	51	53	60	59	55
Long Term												
Full Simulation Period ^b	54	51	47	45	46	47	49	52	55	61	60	56
Water Year Types ^c												
Wet (32%)	51	49	45	45	45	47	49	52	54	61	60	55
Above Normal (16%)	54	51	47	45	45	47	49	52	54	61	60	55
Below Normal (13%)	53	50	47	45	45	47	50	52	54	61	60	56
Dry (24%)	54	51	47	45	46	48	50	52	54	61	61	57
Critical (15%)	56	53	48	46	47	49	51	53	58	61	61	60

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	57	53	49	46	47	48	51	52	57	62	62	58
20%	56	52	48	46	46	48	50	52	55	62	61	57
30%	55	52	48	46	46	48	50	51	55	61	61	57
40%	54	51	47	45	46	47	50	51	55	61	61	56
50%	54	51	47	45	46	47	49	51	54	61	60	56
60%	53	51	47	45	45	47	49	51	54	60	60	56
70%	53	50	46	44	45	47	49	50	53	60	60	55
80%	52	50	46	44	45	46	49	50	53	60	60	55
90%	52	50	46	44	45	46	48	49	53	60	59	54
Long Term												
Full Simulation Period ^b	54	51	47	45	46	47	49	51	55	61	60	56
Water Year Types ^c												
Wet (32%)	51	49	45	45	45	47	49	51	54	61	60	55
Above Normal (16%)	54	51	47	45	45	47	49	51	54	60	60	55
Below Normal (13%)	53	50	47	45	45	47	50	50	54	61	60	56
Dry (24%)	55	51	47	45	46	48	50	51	55	61	61	57
Critical (15%)	56	53	48	46	47	49	51	52	58	61	61	60

No Action Alternative minus Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.7	0.2	0.0	-0.1	0.0	0.0	0.1	-0.9	0.0	-0.2	0.1	0.2
0.2	0.2	0.0	-0.2	0.0	0.0	0.0	0.0	-1.2	0.1	0.1	0.1	0.2
0.3	0.4	0.0	0.2	0.0	0.0	0.0	0.1	-1.1	0.0	-0.1	0.0	0.2
0.4	0.1	0.1	0.0	0.0	0.1	0.1	0.0	-1.2	0.0	0.0	-0.1	0.0
0.5	0.2	-0.1	0.0	0.0	0.0	0.1	0.0	-1.2	0.1	0.0	-0.2	-0.2
0.6	-0.2	0.0	0.1	0.0	0.2	0.1	0.0	-1.1	0.0	-0.1	-0.1	0.1
0.7	-0.1	0.2	0.0	0.1	0.1	0.0	0.1	-1.2	-0.1	-0.1	0.1	-0.1
0.8	0.1	-0.1	0.0	0.0	0.1	0.0	0.0	-1.3	0.1	-0.2	0.0	-0.1
0.9	-0.1	0.0	0.2	0.1	0.0	0.0	-0.1	-1.4	0.1	0.0	-0.1	-0.1
Long Term												
Full Simulation Period ^b	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-1.2	0.0	-0.1	0.0	0.0
Water Year Types ^c												
Wet (32%)	-0.1	0.1	0.0	0.0	0.0	0.0	0.0	-1.2	0.0	-0.1	-0.1	-0.2
Above Normal (16%)	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-1.3	0.0	0.0	0.0	0.1
Below Normal (13%)	0.1	0.0	0.2	0.0	0.0	0.1	0.1	-1.3	-0.2	-0.1	-0.1	0.0
Dry (24%)	0.4	0.0	0.0	0.0	0.0	0.0	0.0	-1.2	0.1	0.0	0.0	0.1
Critical (15%)	0.2	0.1	0.1	0.0	0.1	0.0	0.1	-0.9	0.0	-0.1	-0.1	0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-4-5. Clear Creek at mouth, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	57	53	49	47	47	48	51	53	57	62	62	58
20%	56	52	48	46	46	48	50	53	55	62	61	57
30%	55	52	47	46	46	48	50	52	55	61	61	57
40%	54	51	47	45	46	47	50	52	55	61	61	56
50%	54	51	47	45	46	47	49	52	54	61	60	56
60%	53	51	46	45	45	47	49	52	54	60	60	56
70%	53	50	46	44	45	47	49	52	54	60	60	55
80%	52	50	46	44	45	46	49	51	53	60	60	55
90%	52	50	46	44	44	46	48	51	53	60	59	55
Long Term												
Full Simulation Period ^b	54	51	47	45	46	47	49	52	55	61	60	56
Water Year Types ^c												
Wet (32%)	51	49	45	45	45	47	49	52	54	61	60	55
Above Normal (16%)	54	51	47	45	45	47	49	52	54	61	60	55
Below Normal (13%)	53	50	47	45	45	47	50	52	54	61	60	56
Dry (24%)	54	51	47	45	46	48	50	52	54	61	61	57
Critical (15%)	56	53	48	46	47	49	51	53	58	61	61	60

Alternative 3

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	57	53	49	47	47	48	51	53	57	62	62	58
20%	56	52	48	46	46	48	50	53	55	62	61	57
30%	55	52	47	46	46	48	50	52	55	61	61	57
40%	54	51	47	45	46	47	50	52	54	61	61	56
50%	54	51	47	45	46	47	49	52	54	61	60	56
60%	53	51	46	45	45	47	49	52	54	60	60	56
70%	53	50	46	44	45	47	49	51	53	60	60	55
80%	52	50	46	44	45	46	49	51	53	60	60	55
90%	52	50	46	44	44	46	48	51	53	60	59	55
Long Term												
Full Simulation Period ^b	54	51	47	45	46	47	49	52	55	61	60	56
Water Year Types ^c												
Wet (32%)	51	49	45	45	45	47	49	52	54	61	60	55
Above Normal (16%)	54	51	47	45	45	47	49	52	54	61	60	55
Below Normal (13%)	53	51	47	45	45	47	50	52	54	61	60	56
Dry (24%)	54	51	47	45	46	48	50	52	54	61	61	57
Critical (15%)	56	53	48	46	47	49	51	53	58	61	61	60

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.2	-0.1	0.0	0.0	0.0	-0.1
0.2	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0
0.3	0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.2	0.0	0.1
0.4	0.1	0.0	-0.1	0.0	0.0	0.0	0.0	-0.1	-0.1	0.0	-0.1	0.0
0.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.0	0.0	0.0
0.6	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	-0.1	0.0
0.7	0.1	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.0	0.0	0.0
0.8	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	-0.1	-0.1	-0.2	0.1	0.0
0.9	0.0	0.0	-0.1	0.2	0.0	0.0	-0.1	-0.1	0.0	-0.1	0.0	-0.1
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	-0.1	-0.1	0.0
Critical (15%)	-0.1	-0.2	-0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.0	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-4-6. Clear Creek at mouth, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	57	53	49	47	47	48	51	53	57	62	62	58
20%	56	52	48	46	46	48	50	53	55	62	61	57
30%	55	52	47	46	46	48	50	52	55	61	61	57
40%	54	51	47	45	46	47	50	52	55	61	61	56
50%	54	51	47	45	46	47	49	52	54	61	60	56
60%	53	51	46	45	45	47	49	52	54	60	60	56
70%	53	50	46	44	45	47	49	52	54	60	60	55
80%	52	50	46	44	45	46	49	51	53	60	60	55
90%	52	50	46	44	44	46	48	51	53	60	59	55
Long Term												
Full Simulation Period ^b	54	51	47	45	46	47	49	52	55	61	60	56
Water Year Types ^c												
Wet (32%)	51	49	45	45	45	47	49	52	54	61	60	55
Above Normal (16%)	54	51	47	45	45	47	49	52	54	61	60	55
Below Normal (13%)	53	50	47	45	45	47	50	52	54	61	60	56
Dry (24%)	54	51	47	45	46	48	50	52	54	61	61	57
Critical (15%)	56	53	48	46	47	49	51	53	58	61	61	60

Alternative 5

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	57	53	49	46	47	48	51	53	57	62	62	58
20%	56	52	48	46	46	48	50	52	56	62	61	57
30%	55	52	48	46	46	48	50	51	55	61	61	57
40%	54	51	47	45	46	47	50	51	55	61	61	57
50%	54	51	47	45	46	47	49	51	54	61	60	56
60%	53	51	47	45	45	47	49	51	54	60	60	56
70%	53	50	46	44	45	47	49	50	53	60	60	55
80%	52	50	46	44	45	46	49	50	53	60	60	55
90%	52	50	46	44	45	46	48	49	53	60	59	54
Long Term												
Full Simulation Period ^b	54	51	47	45	46	47	49	51	55	61	60	56
Water Year Types ^c												
Wet (32%)	51	49	45	45	45	47	49	51	54	61	60	55
Above Normal (16%)	55	51	47	45	45	47	49	50	54	60	60	55
Below Normal (13%)	53	50	47	45	45	47	50	51	54	61	60	56
Dry (24%)	55	51	47	45	46	48	50	51	54	61	61	57
Critical (15%)	56	53	48	46	47	49	51	53	58	61	61	59

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.7	0.2	-0.1	-0.1	0.0	0.0	0.2	-0.9	0.0	-0.1	0.1	0.1
0.2	0.2	0.0	-0.2	0.0	0.0	0.0	0.0	-1.1	0.1	0.1	0.0	0.2
0.3	0.4	0.0	0.3	0.0	0.0	0.0	0.1	-1.1	0.0	0.0	-0.1	0.2
0.4	0.0	0.1	0.0	0.0	0.1	0.1	0.0	-1.2	0.0	0.0	-0.1	0.1
0.5	0.1	-0.1	0.0	0.0	0.0	0.1	0.0	-1.2	0.1	0.0	-0.2	-0.1
0.6	-0.3	0.0	0.0	0.0	0.1	0.1	0.0	-1.1	0.0	-0.1	-0.2	-0.1
0.7	-0.2	0.1	0.0	0.1	0.1	0.0	0.1	-1.2	0.0	-0.1	0.0	-0.1
0.8	0.1	0.0	0.0	0.0	0.1	0.0	0.0	-1.2	0.0	-0.1	0.0	-0.1
0.9	-0.1	0.1	0.1	0.2	0.0	0.0	-0.1	-1.4	0.1	0.0	0.0	-0.1
Long Term												
Full Simulation Period ^b	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-1.1	0.1	0.0	-0.1	0.0
Water Year Types ^c												
Wet (32%)	-0.1	0.1	0.0	0.0	0.0	0.0	0.0	-1.1	0.0	0.0	0.0	-0.2
Above Normal (16%)	0.2	0.1	0.0	0.0	0.0	0.0	-0.1	-1.3	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.2	0.0	0.0	0.1	0.1	-1.1	-0.1	-0.1	0.0	0.1
Dry (24%)	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-1.2	0.1	0.0	0.0	0.1
Critical (15%)	0.2	0.1	0.1	0.0	0.1	0.0	0.1	-0.6	0.3	0.1	-0.2	-0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


B.5. Sacramento River below Keswick Temperature

Figure B-5-1. Sacramento River below Keswick, October

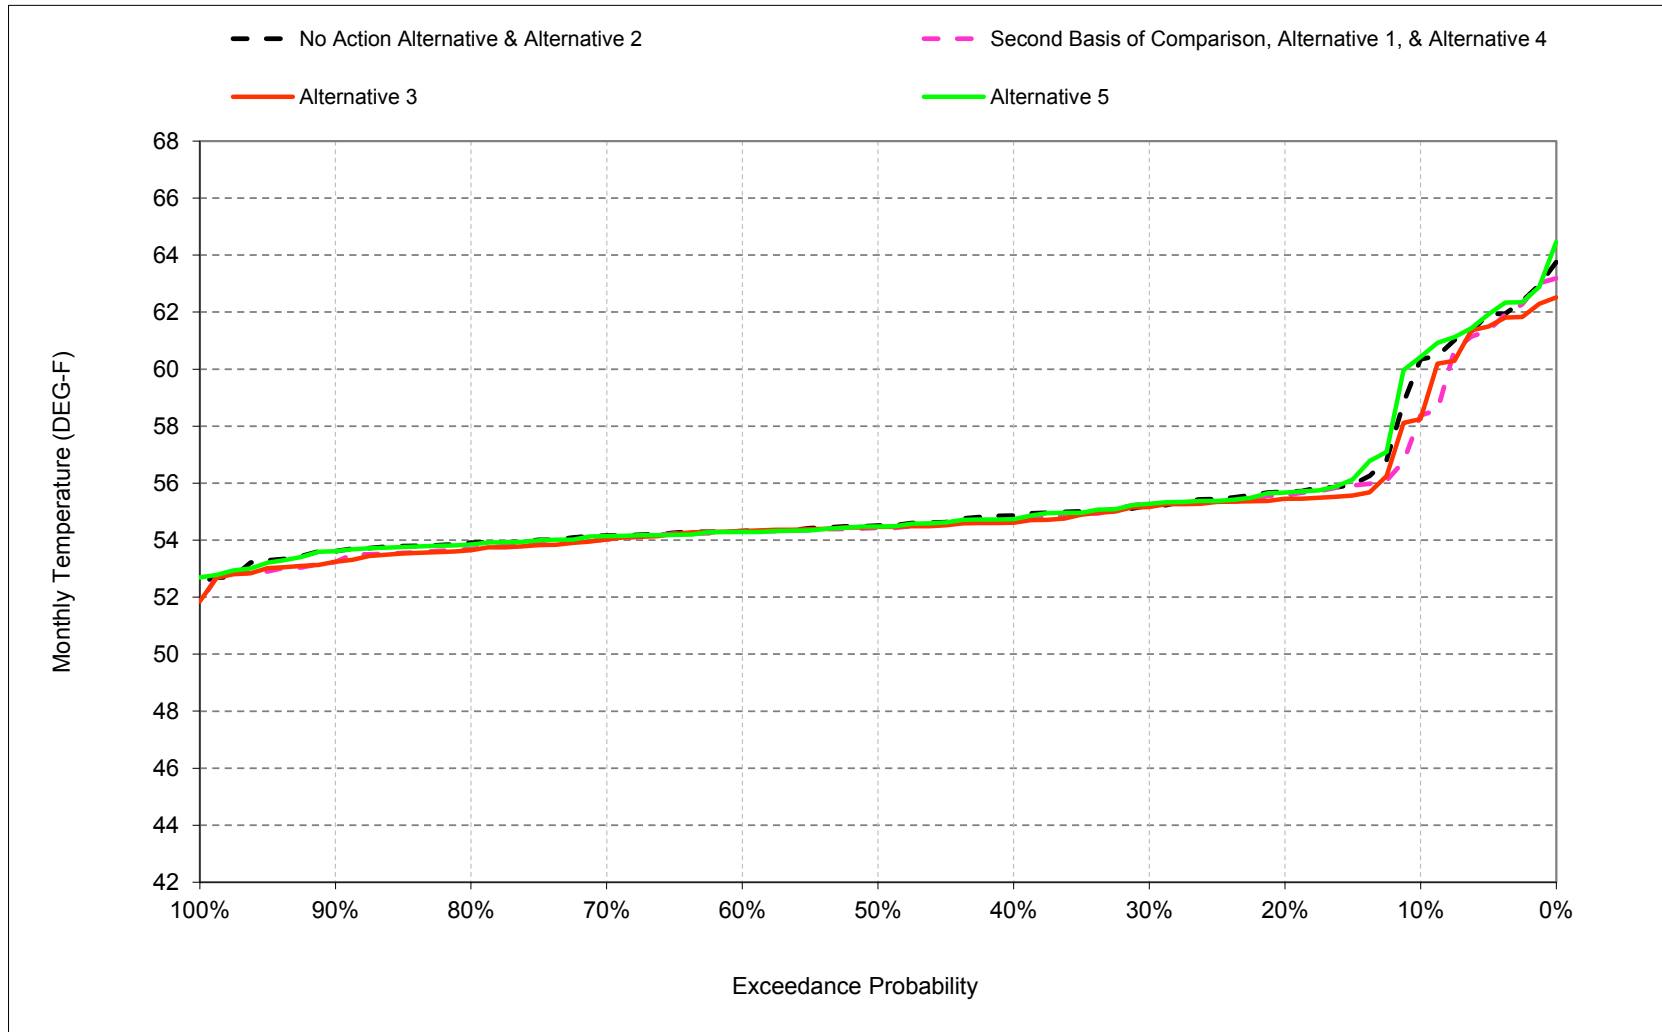


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-5-2. Sacramento River below Keswick, November

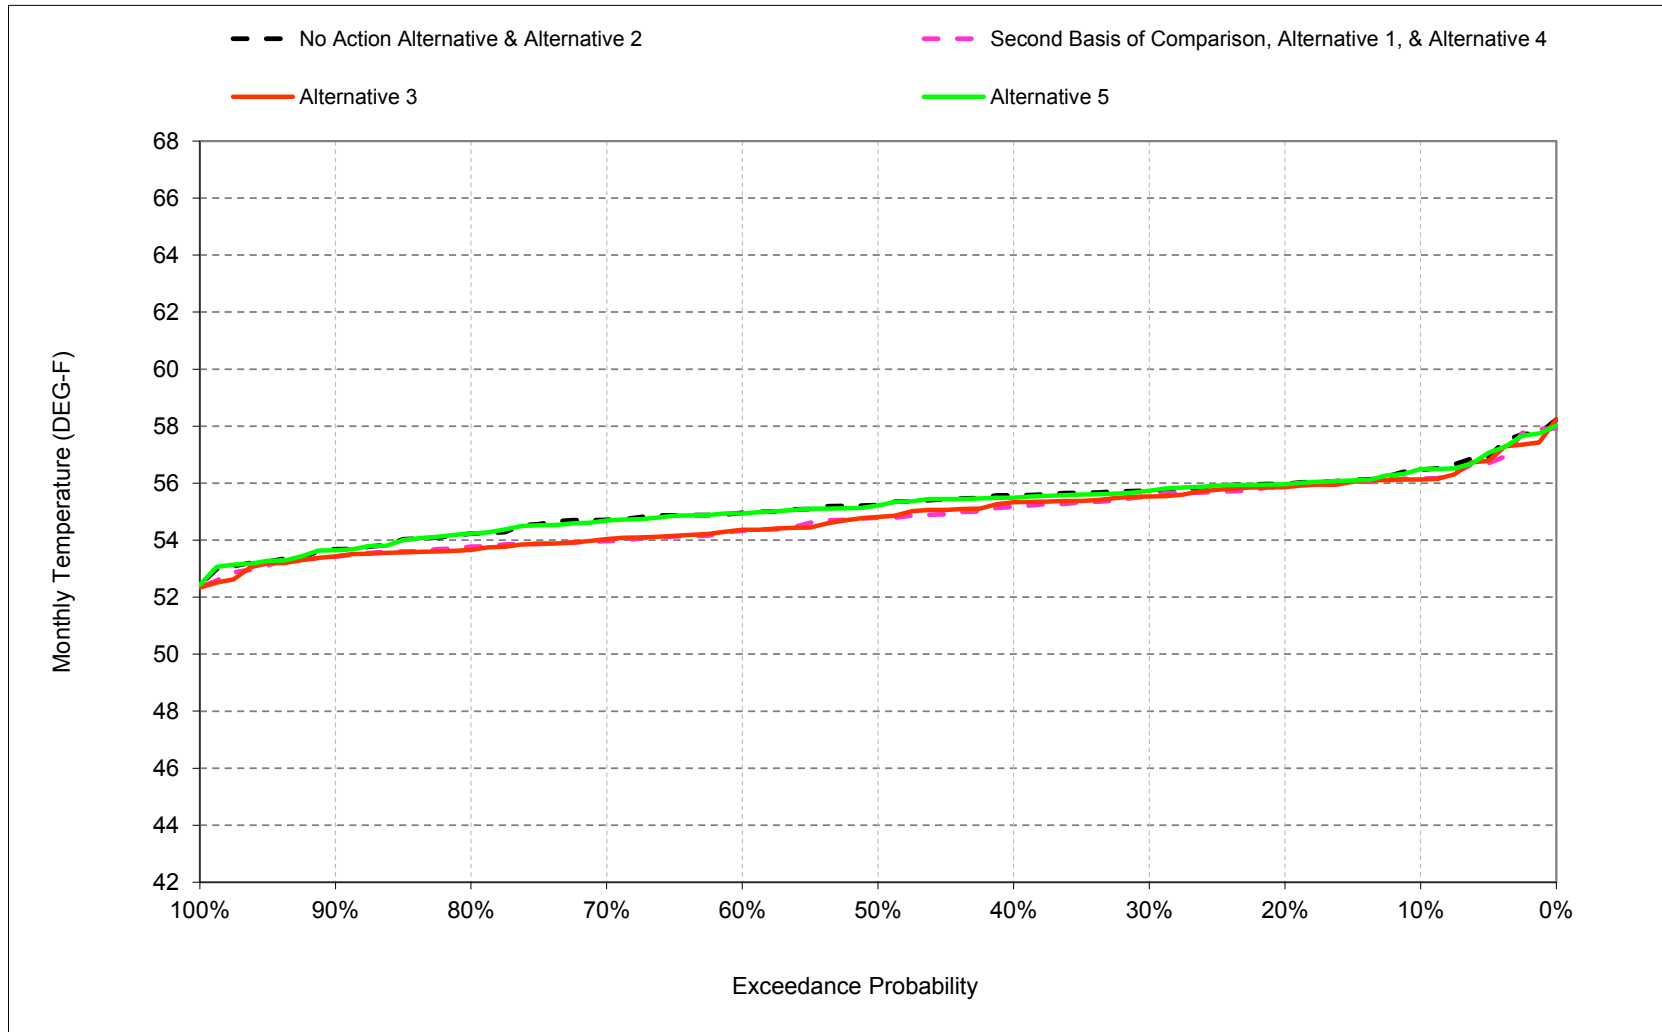


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-5-3. Sacramento River below Keswick, December

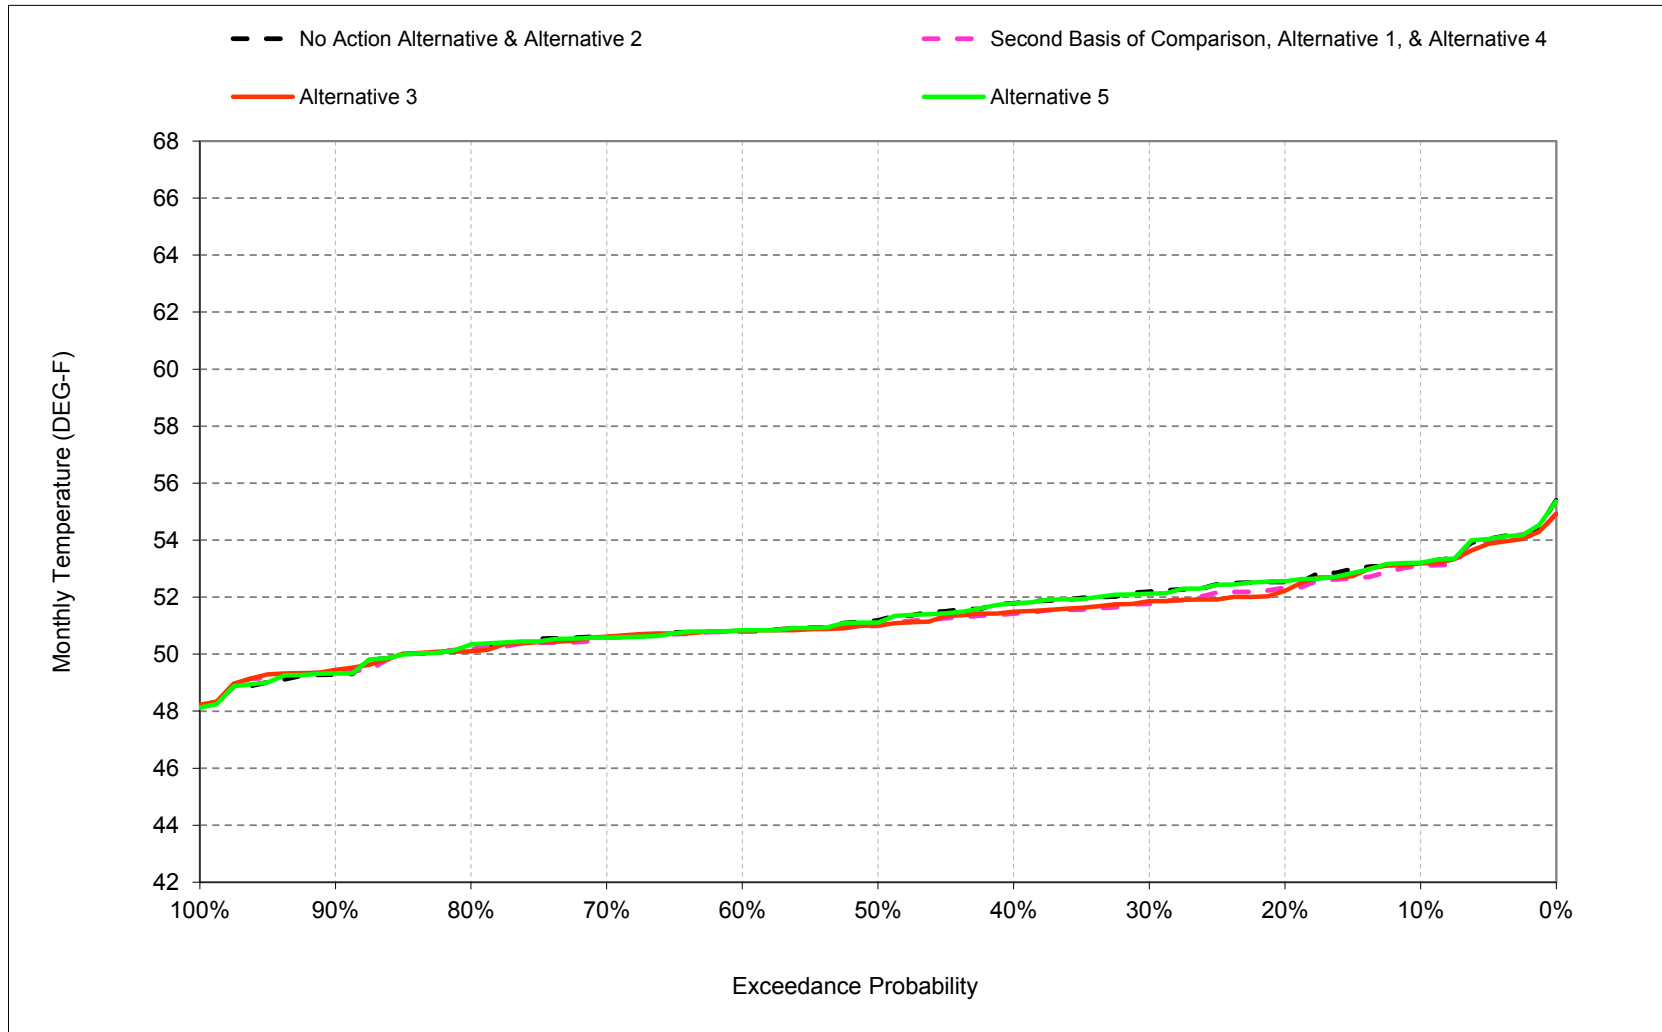


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-5-4. Sacramento River below Keswick, January

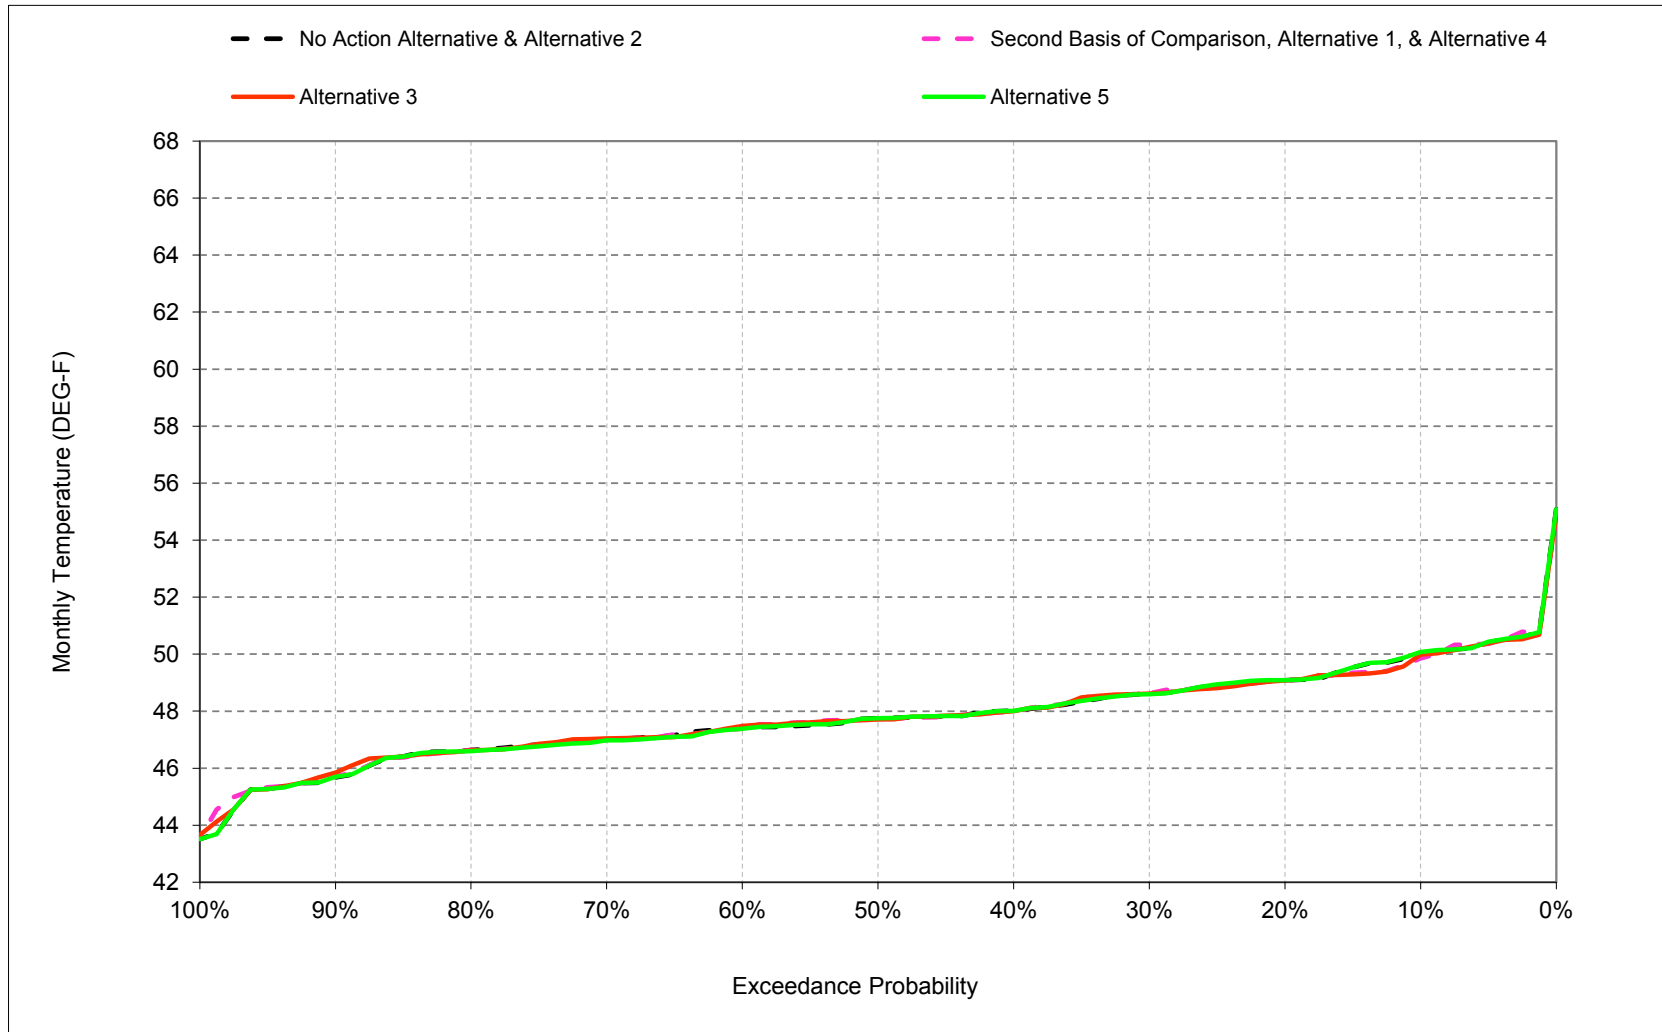


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-5-5. Sacramento River below Keswick, February

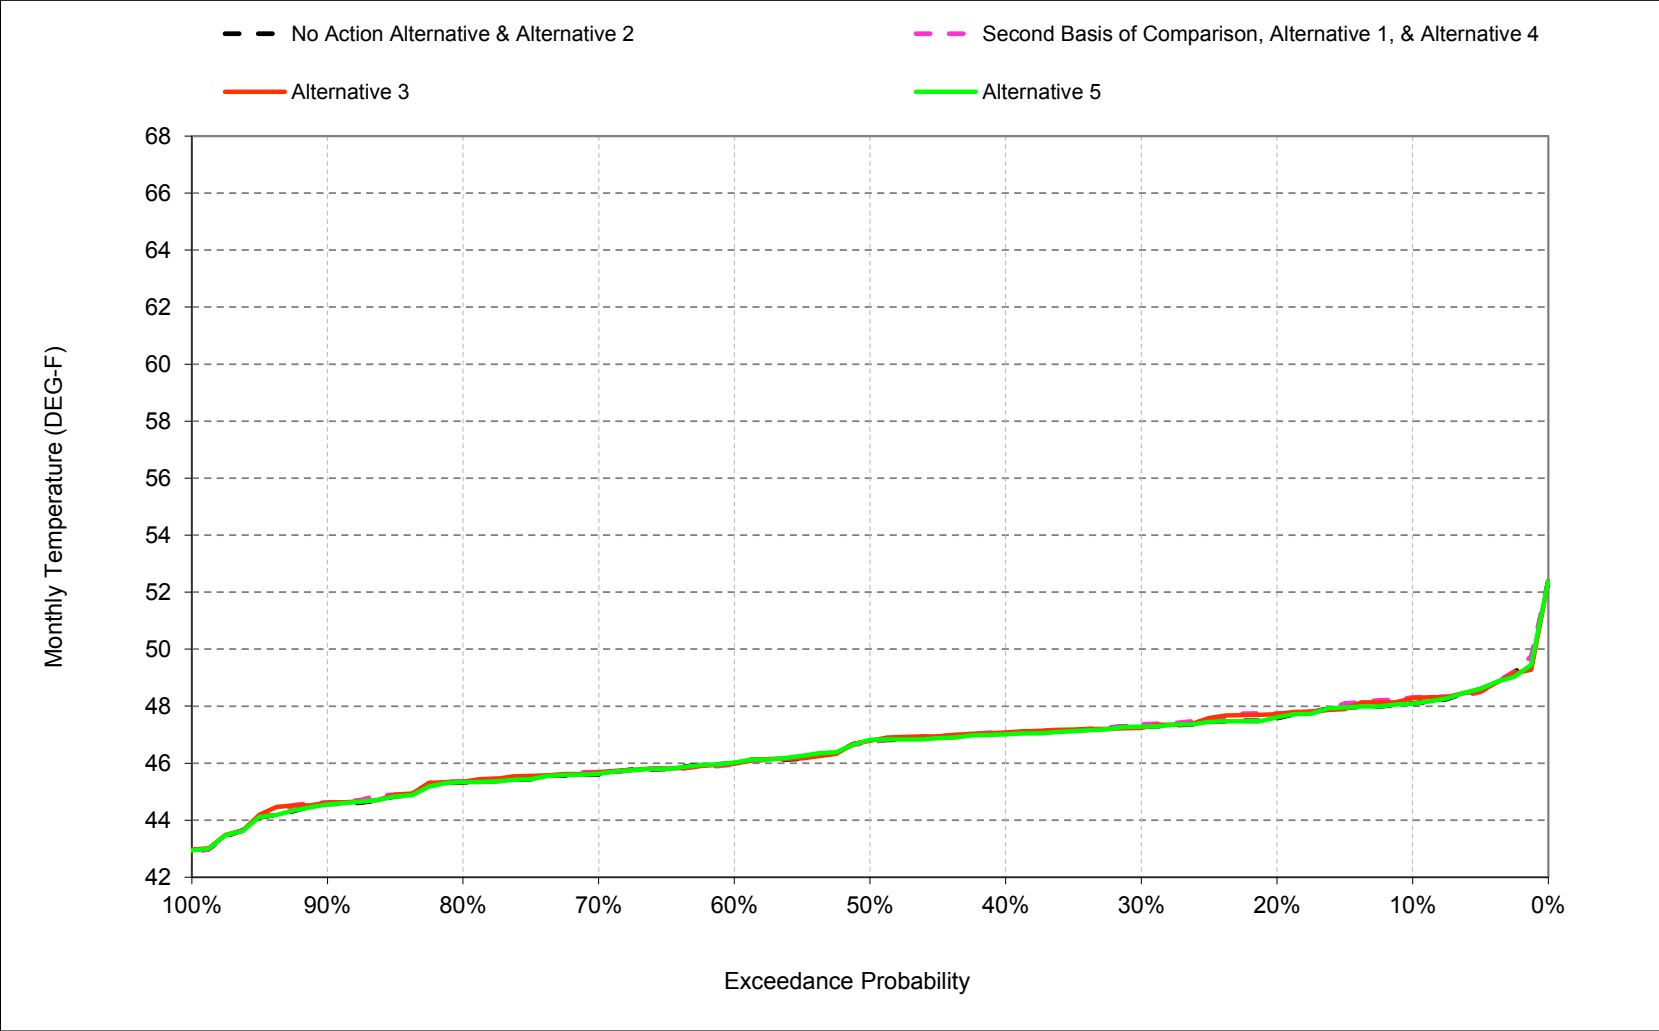


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-5-6. Sacramento River below Keswick, March

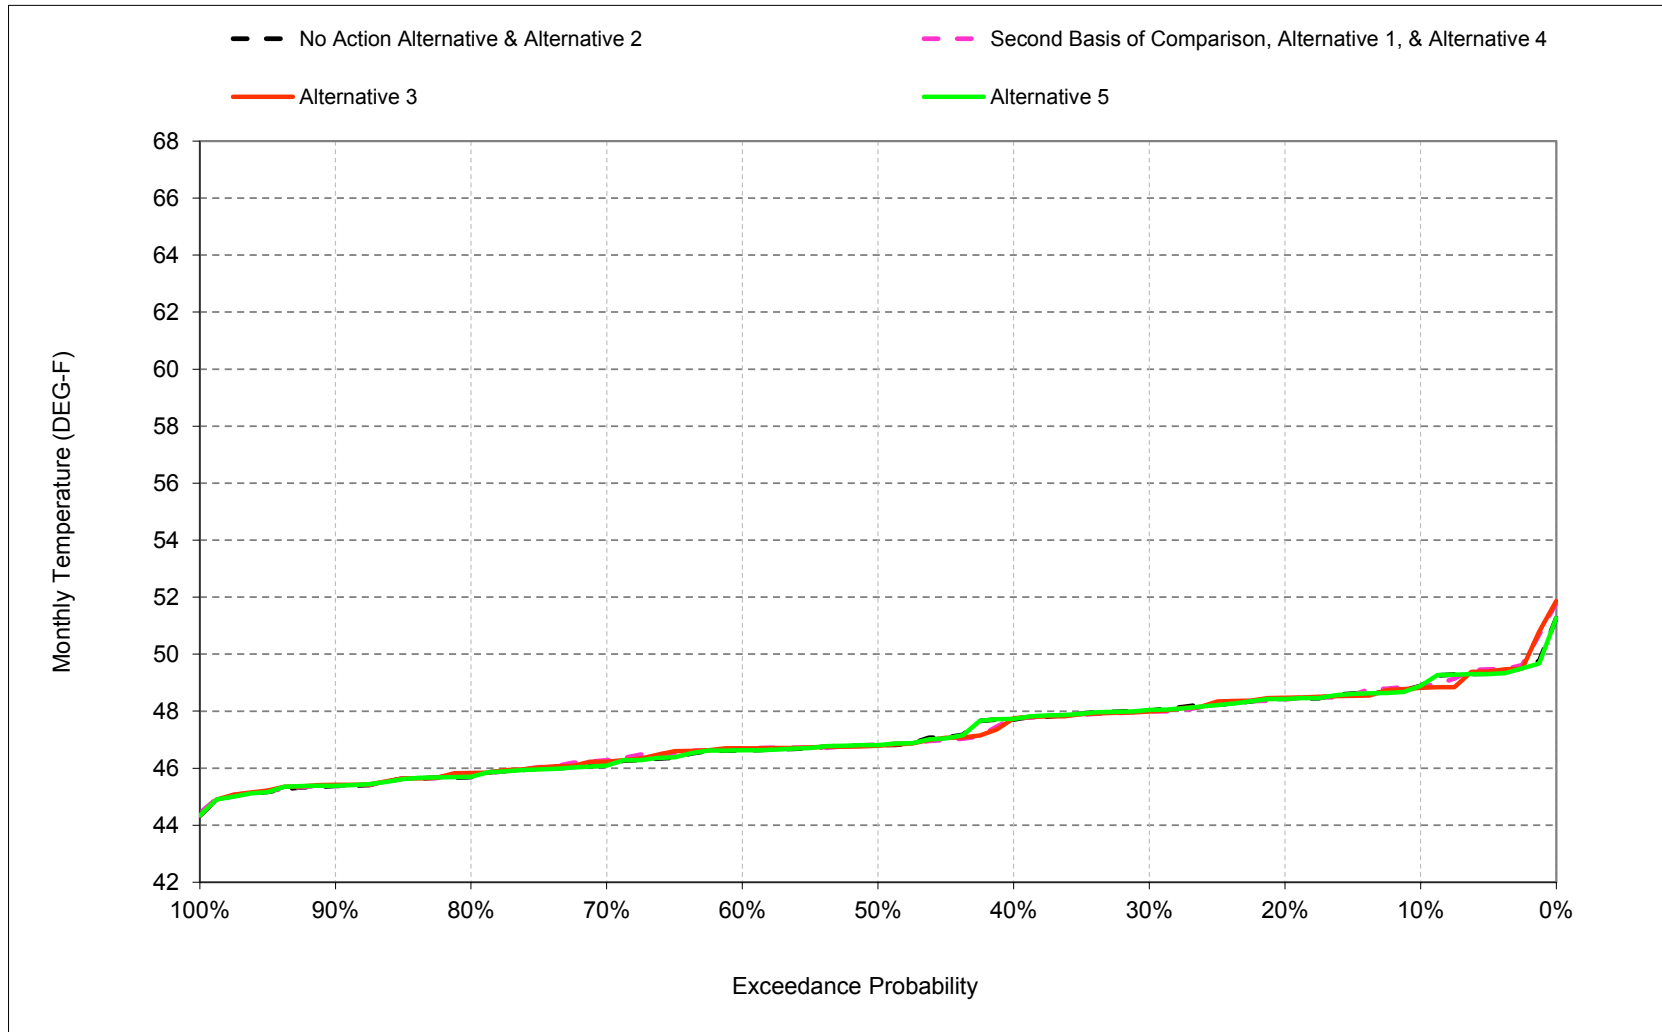


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-5-7. Sacramento River below Keswick, April

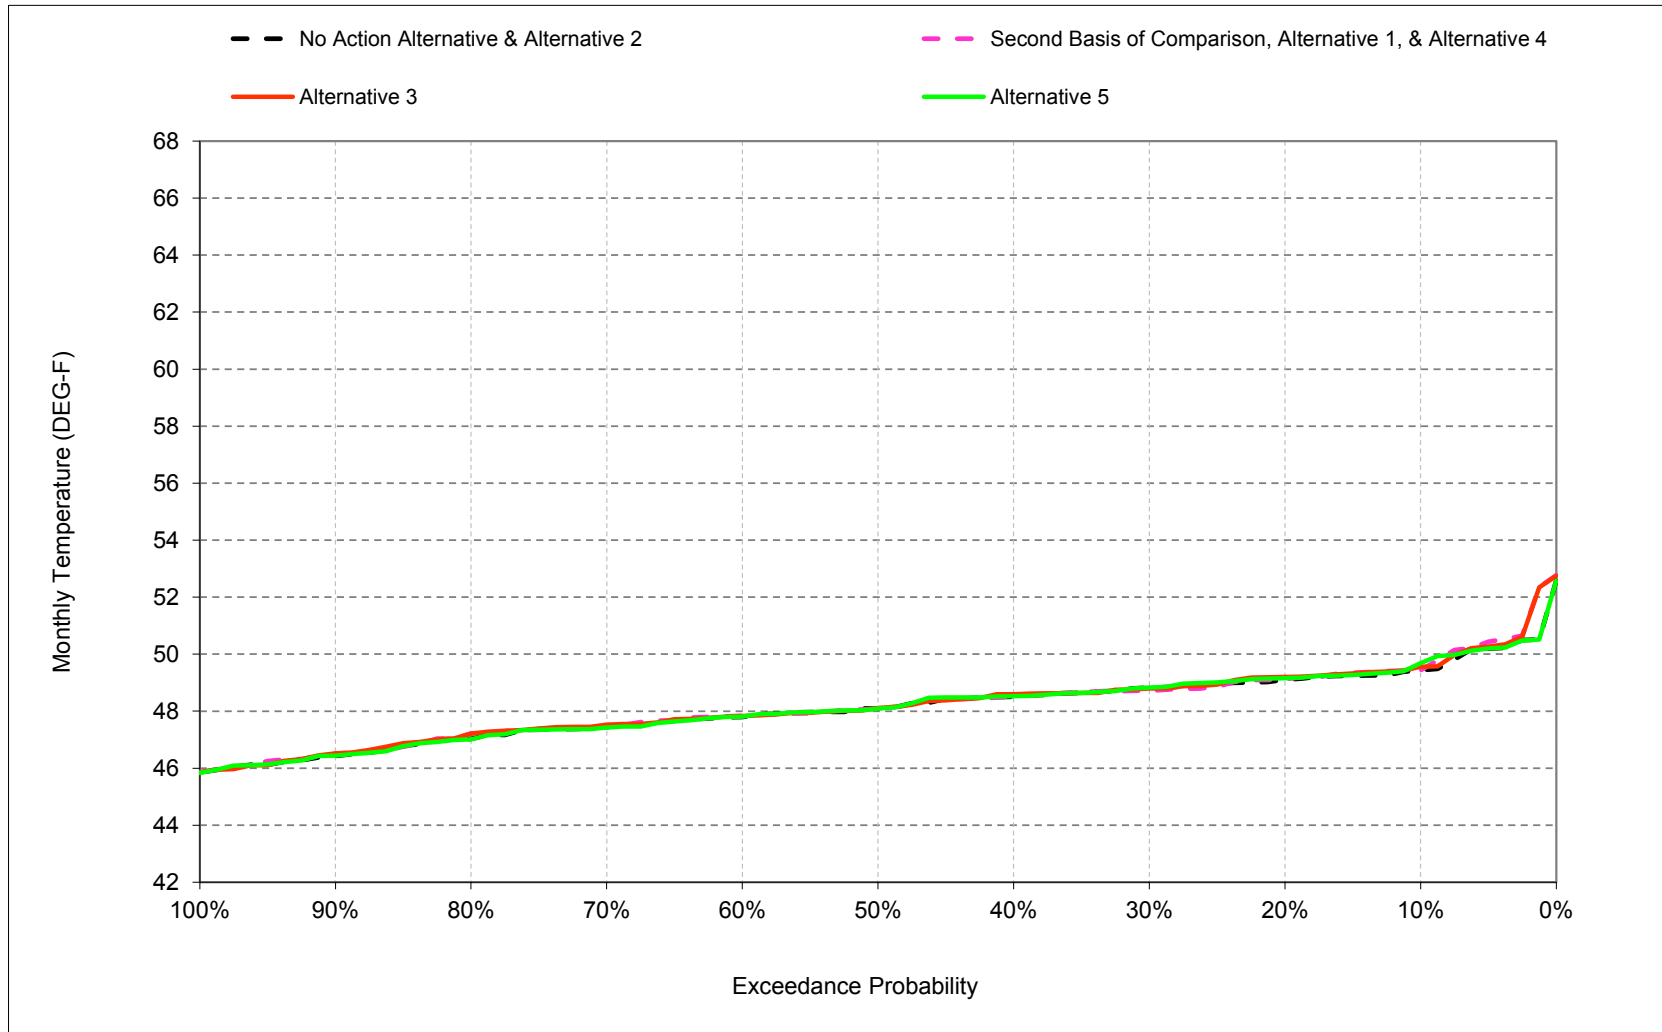


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-5-8. Sacramento River below Keswick, May

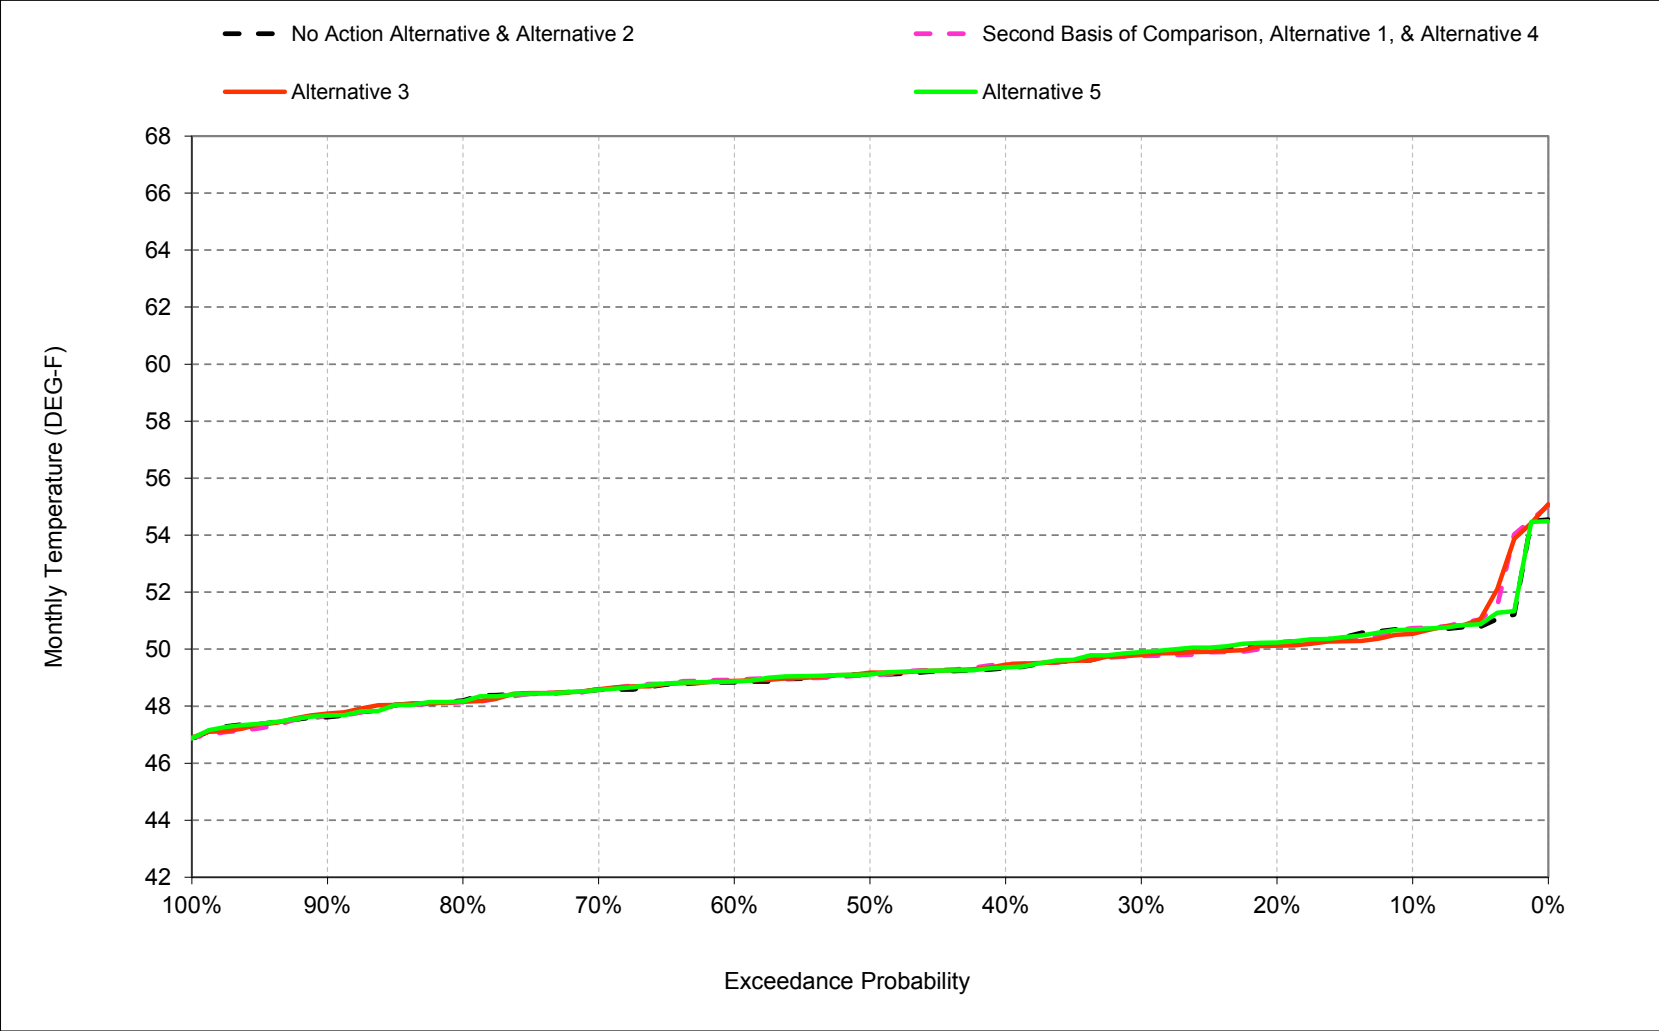


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-5-9. Sacramento River below Keswick, June

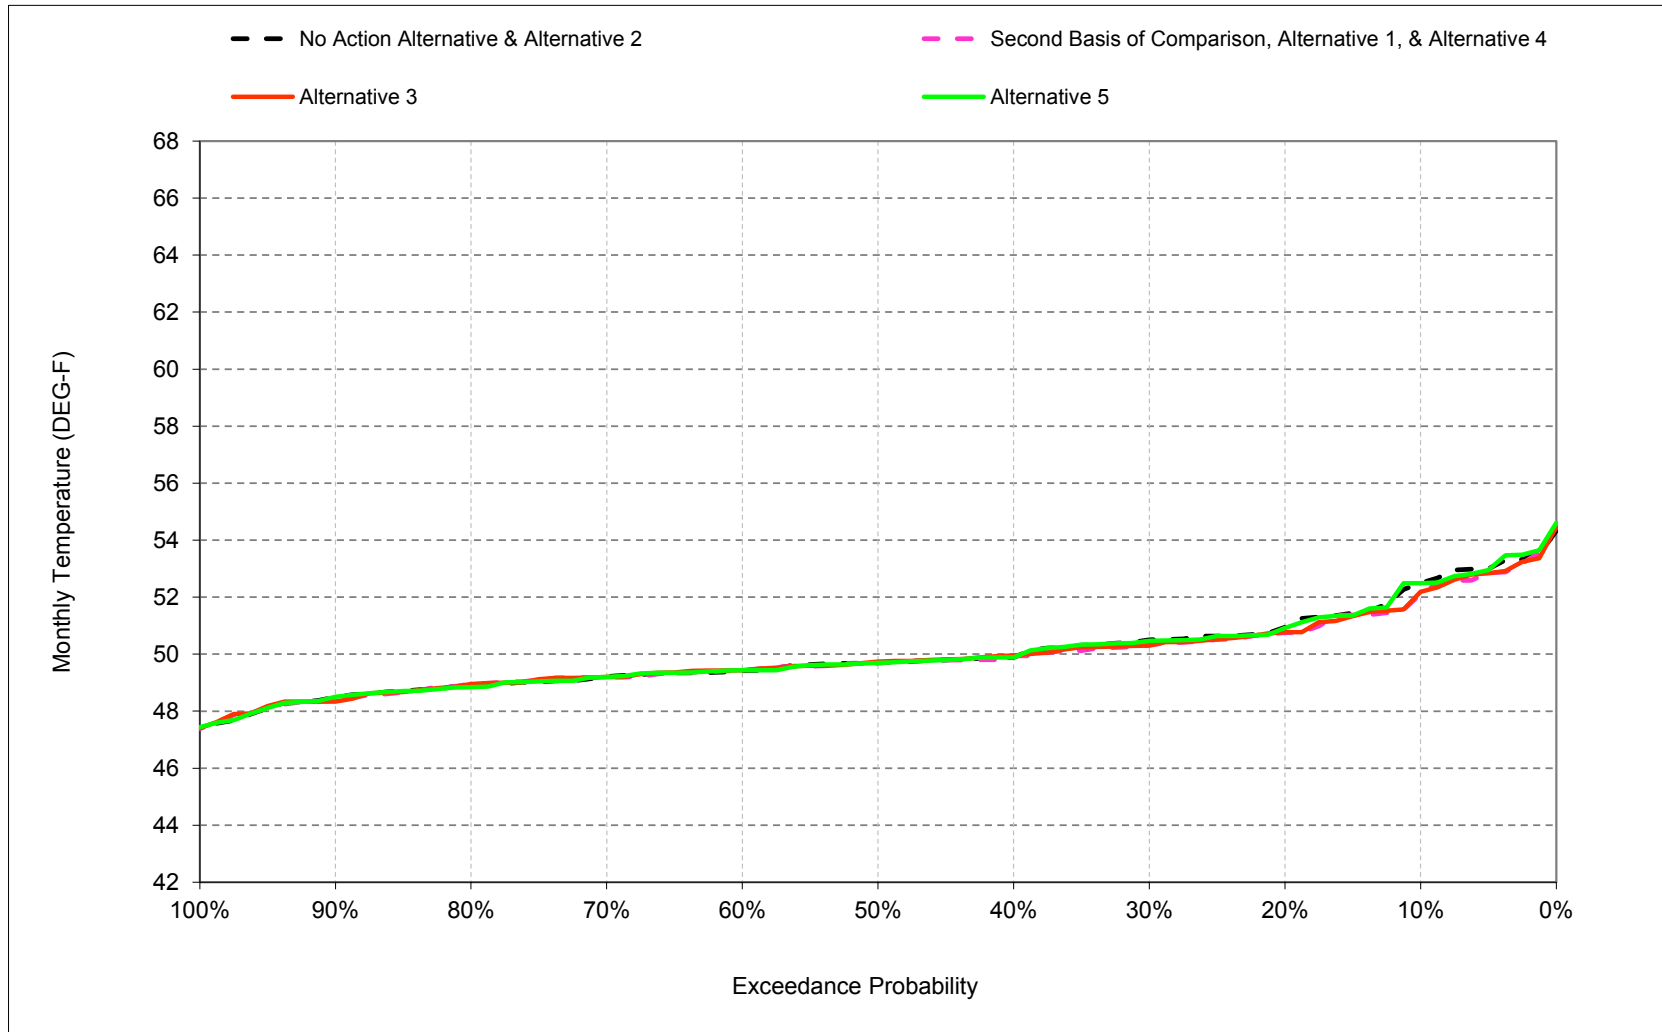


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-5-10. Sacramento River below Keswick, July

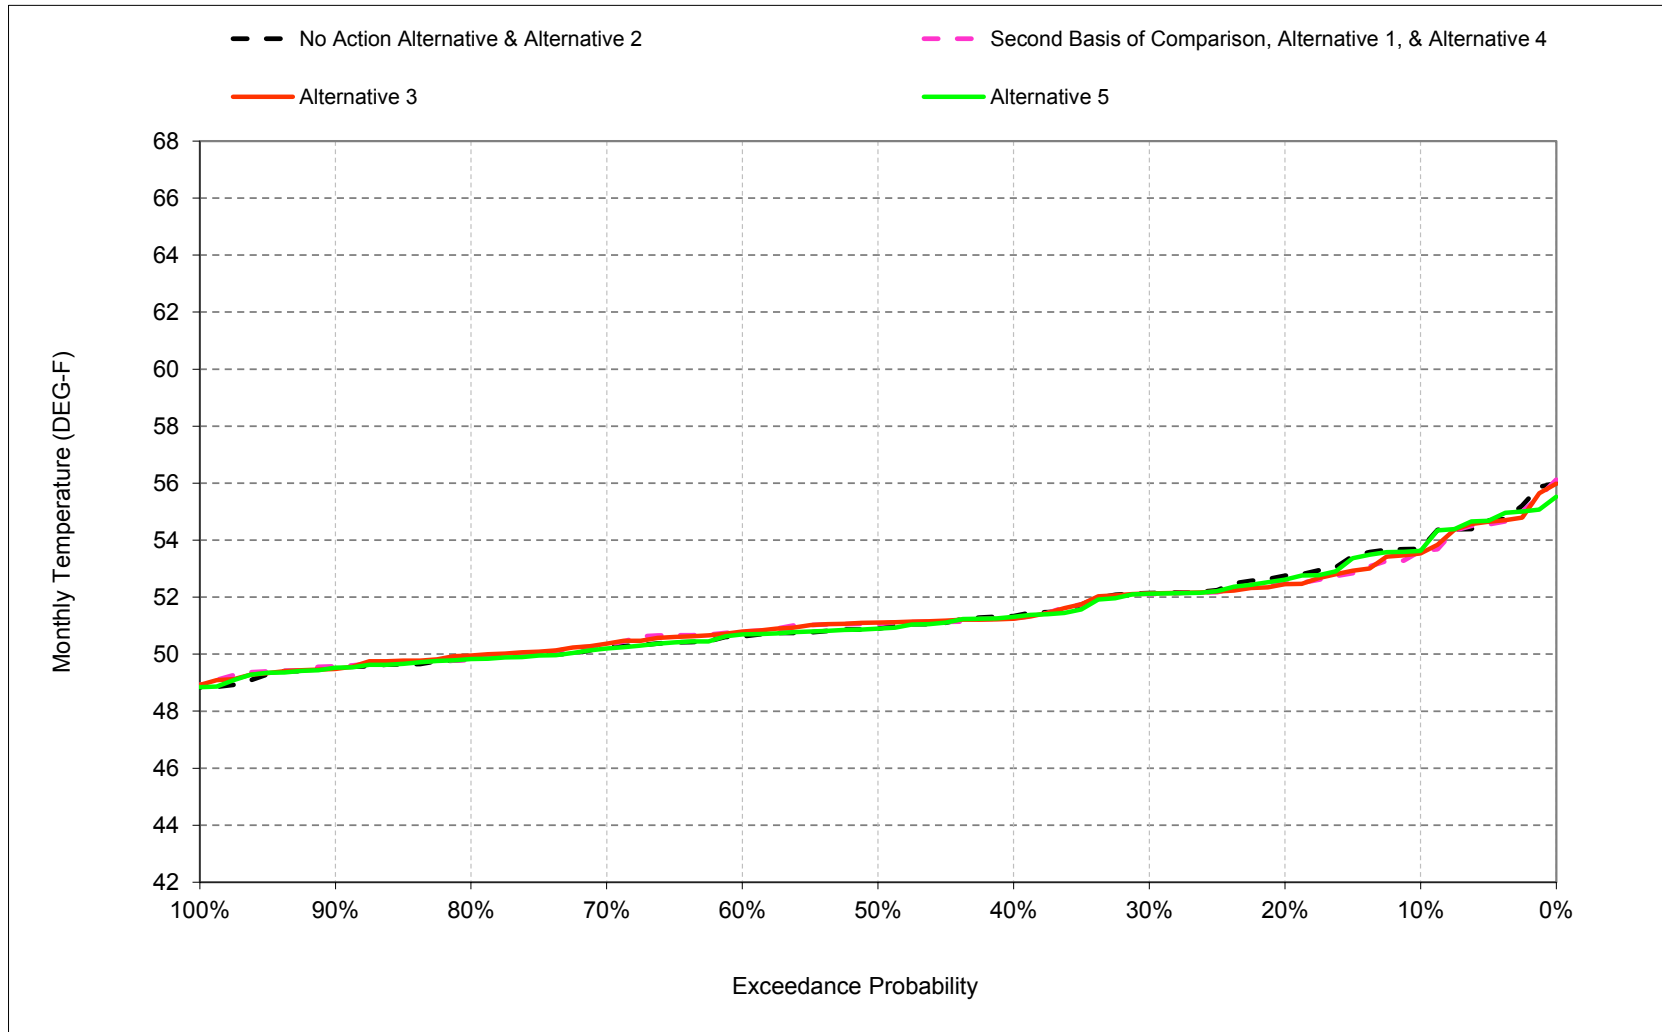


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-5-11. Sacramento River below Keswick, August

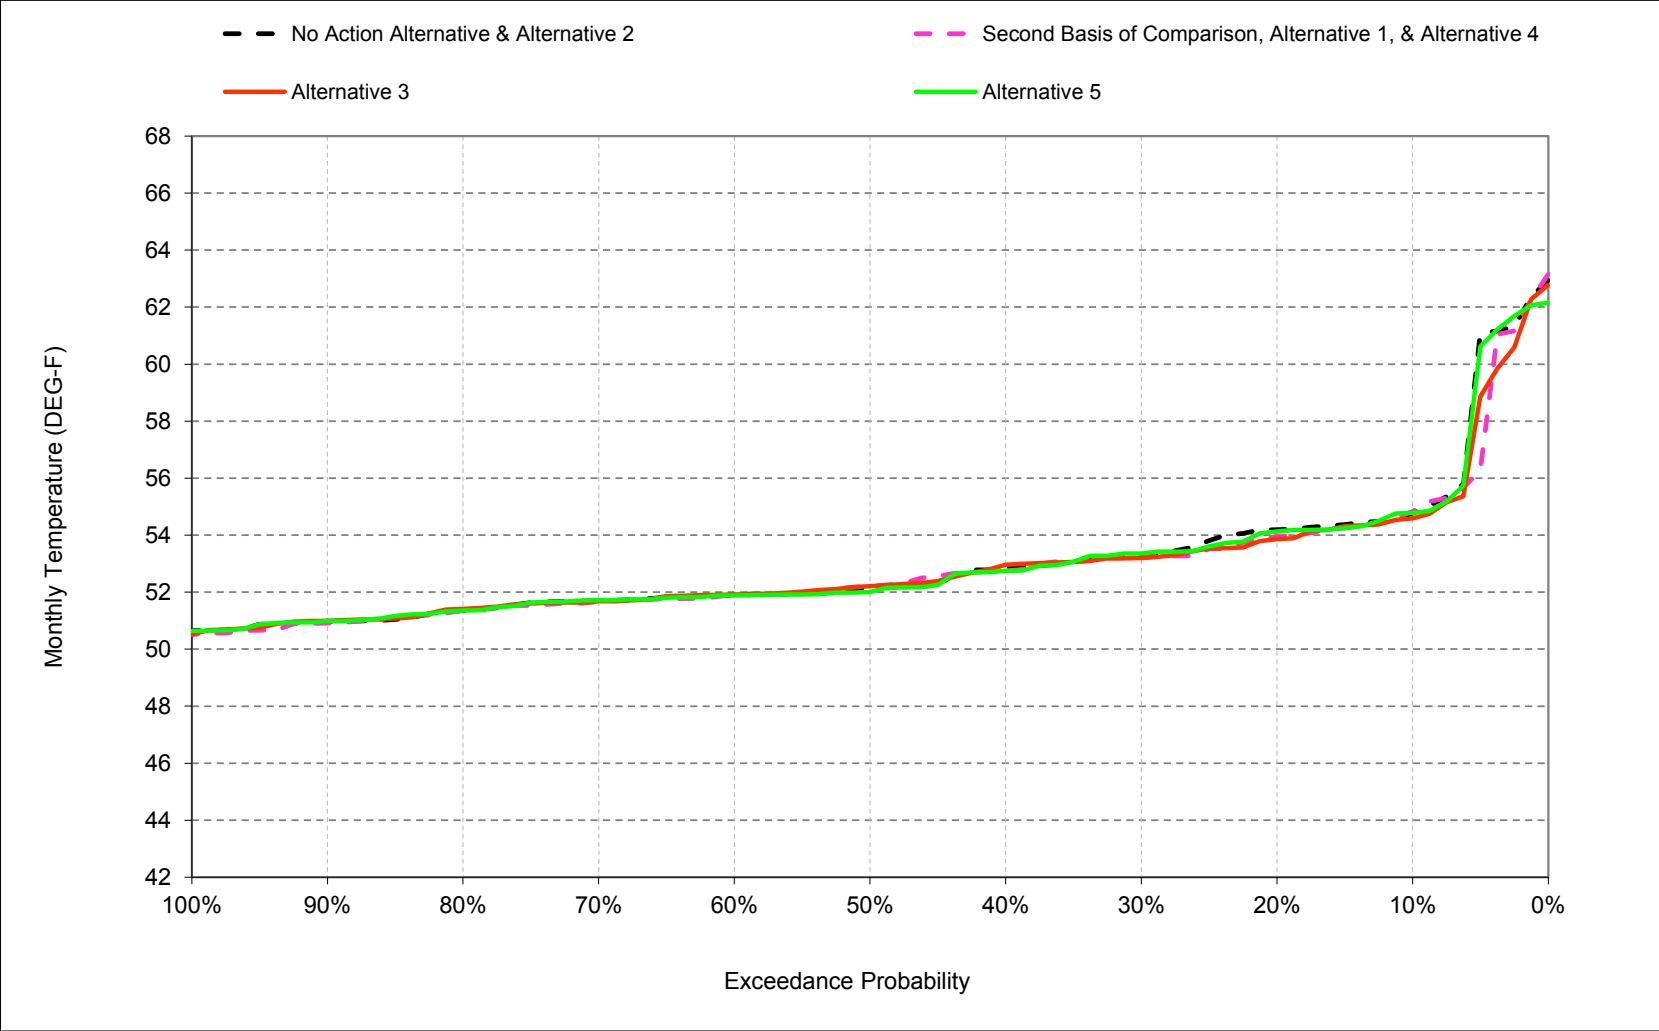

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-5-12. Sacramento River below Keswick, September

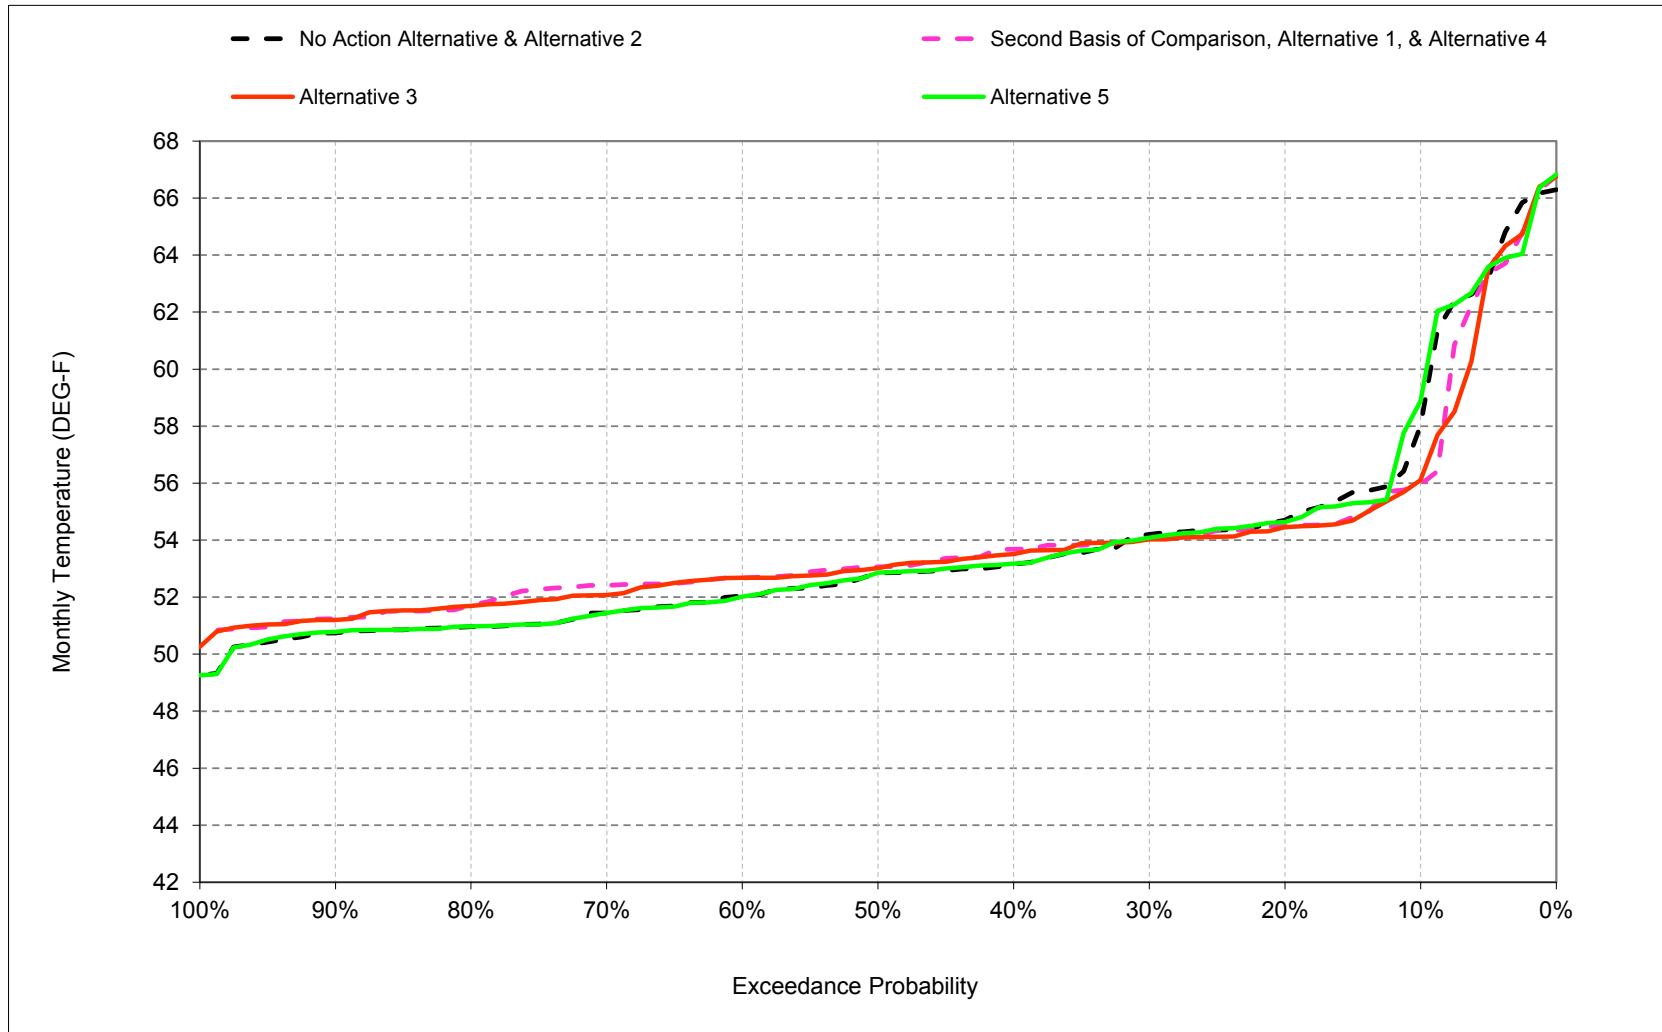

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-5-1. Sacramento River below Keswick, Monthly Temperature

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance ^a												
10%	60	56	53	50	48	49	49	51	52	54	55	58
20%	56	56	53	49	48	48	49	50	51	53	54	55
30%	55	56	52	49	47	48	49	50	50	52	53	54
40%	55	56	52	48	47	48	49	49	50	51	53	53
50%	55	55	51	48	47	47	48	49	50	51	52	53
60%	54	55	51	47	46	47	48	49	49	51	52	52
70%	54	55	51	47	46	46	47	49	49	50	52	51
80%	54	54	50	47	45	46	47	48	49	50	51	51
90%	54	54	49	46	45	45	46	48	48	49	51	51
Long Term												
Full Simulation Period ^b	55	55	51	48	46	47	48	49	50	51	53	54
Water Year Types ^c												
Wet (32%)	53	53	49	47	46	46	48	49	49	51	52	51
Above Normal (16%)	55	55	51	47	46	46	48	49	49	50	51	51
Below Normal (13%)	55	55	52	48	47	48	48	49	50	51	52	53
Dry (24%)	55	55	52	48	47	48	49	49	50	52	53	54
Critical (15%)	58	56	52	48	47	48	49	51	52	54	58	61

Alternative 1

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	58	56	53	50	48	49	49	51	52	54	55	56
20%	56	56	52	49	48	48	49	50	51	52	54	55
30%	55	56	52	49	47	48	49	50	50	52	53	54
40%	55	55	51	48	47	48	49	49	50	51	53	54
50%	54	55	51	48	47	47	48	49	50	51	52	53
60%	54	54	51	47	46	47	48	49	49	51	52	53
70%	54	54	51	47	46	46	47	49	49	50	52	52
80%	54	54	50	47	45	46	47	48	49	50	51	52
90%	53	53	49	46	45	45	46	48	48	50	51	51
Long Term												
Full Simulation Period ^b	55	55	51	48	46	47	48	49	50	51	53	54
Water Year Types ^c												
Wet (32%)	52	52	49	47	46	46	48	49	49	51	52	52
Above Normal (16%)	55	54	51	47	46	46	48	49	49	50	51	52
Below Normal (13%)	54	55	51	48	47	48	49	49	50	51	52	53
Dry (24%)	55	55	51	48	47	48	49	49	50	51	53	54
Critical (15%)	57	56	52	48	47	48	49	51	52	54	57	60

Alternative 1 minus No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-2.0	-0.3	-0.1	0.0	0.2	0.0	0.0	0.0	-0.4	-0.1	0.1	-1.9
0.2	-0.1	-0.1	-0.2	0.0	0.2	0.0	0.0	-0.1	-0.2	-0.3	-0.3	-0.2
0.3	0.1	-0.2	-0.4	0.0	0.0	0.0	-0.1	-0.1	-0.2	0.0	-0.1	-0.1
0.4	-0.1	-0.4	-0.4	0.0	0.0	-0.1	0.0	0.1	0.0	-0.1	-0.1	0.6
0.5	-0.1	-0.4	-0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.1	0.3
0.6	0.0	-0.6	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.2	0.0	0.7
0.7	-0.1	-0.7	0.0	0.0	0.1	0.2	0.0	0.0	0.0	0.1	-0.1	0.9
0.8	-0.2	-0.5	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.8
0.9	-0.4	-0.3	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.5
Long Term												
Full Simulation Period ^b	-0.2	-0.4	-0.1	0.0	0.0	0.0	0.1	0.0	-0.1	0.0	-0.1	0.2
Water Year Types ^c												
Wet (32%)	-0.2	-0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	1.0
Above Normal (16%)	-0.1	-0.4	-0.1	0.0	0.1	0.0	0.1	0.0	0.0	0.2	0.0	0.8
Below Normal (13%)	-0.3	-0.6	-0.5	-0.1	0.0	-0.1	0.2	0.3	0.0	0.0	-0.2	0.1
Dry (24%)	0.1	-0.3	-0.2	-0.1	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	-0.1
Critical (15%)	-0.8	-0.2	0.0	0.3	0.2	0.1	0.1	0.0	-0.2	-0.1	-0.5	-1.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-5-2. Sacramento River below Keswick, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	60	56	53	50	48	49	49	51	52	54	55	58
20%	56	56	53	49	48	48	49	50	51	53	54	55
30%	55	56	52	49	47	48	49	50	50	52	53	54
40%	55	56	52	48	47	48	49	49	50	51	53	53
50%	55	55	51	48	47	47	48	49	50	51	52	53
60%	54	55	51	47	46	47	48	49	49	51	52	52
70%	54	55	51	47	46	46	47	49	49	50	52	51
80%	54	54	50	47	45	46	47	48	49	50	51	51
90%	54	54	49	46	45	45	46	48	48	49	51	51
Long Term												
Full Simulation Period ^b	55	55	51	48	46	47	48	49	50	51	53	54
Water Year Types ^c												
Wet (32%)	53	53	49	47	46	46	48	49	49	51	52	51
Above Normal (16%)	55	55	51	47	46	46	48	49	49	50	51	51
Below Normal (13%)	55	55	52	48	47	48	48	49	50	51	52	53
Dry (24%)	55	55	52	48	47	48	49	49	50	52	53	54
Critical (15%)	58	56	52	48	47	48	49	51	52	54	58	61

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	58	56	53	50	48	49	50	51	52	54	55	56
20%	55	56	52	49	48	48	49	50	51	52	54	54
30%	55	56	52	49	47	48	49	50	50	52	53	54
40%	55	55	51	48	47	48	49	49	50	51	53	53
50%	54	55	51	48	47	47	48	49	50	51	52	53
60%	54	54	51	47	46	47	48	49	49	51	52	53
70%	54	54	51	47	46	46	47	49	49	50	52	52
80%	54	54	50	47	45	46	47	48	49	50	51	52
90%	53	53	49	46	45	45	46	48	48	49	51	51
Long Term												
Full Simulation Period ^b	55	55	51	48	46	47	48	49	50	51	53	54
Water Year Types ^c												
Wet (32%)	52	53	49	47	46	46	48	49	49	51	52	52
Above Normal (16%)	55	54	51	47	46	46	48	49	49	50	51	52
Below Normal (13%)	54	55	52	48	47	48	49	49	50	51	52	53
Dry (24%)	55	55	51	48	47	48	49	49	50	51	53	54
Critical (15%)	57	56	52	48	47	48	49	51	52	54	57	60

Alternative 3 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-2.1	-0.3	0.0	0.1	0.2	-0.1	0.1	-0.2	-0.3	-0.2	-0.2	-1.8
0.2	-0.2	-0.1	-0.3	0.0	0.2	0.0	0.1	-0.1	-0.1	-0.3	-0.3	-0.3
0.3	-0.1	-0.2	-0.3	0.0	-0.1	0.0	0.0	0.0	-0.2	0.0	-0.1	-0.2
0.4	-0.3	-0.2	-0.3	0.0	0.0	-0.1	0.1	0.1	0.1	-0.1	0.1	0.4
0.5	-0.1	-0.4	-0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.1	0.2
0.6	0.0	-0.6	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.1	0.0	0.7
0.7	-0.1	-0.7	0.0	0.1	0.0	0.1	0.1	0.0	0.0	0.1	0.0	0.6
0.8	-0.3	-0.6	-0.1	0.0	0.0	0.1	0.1	0.0	0.0	0.1	0.1	0.7
0.9	-0.4	-0.2	0.2	0.2	0.0	0.1	0.1	0.1	0.0	0.0	0.0	0.5
Long Term												
Full Simulation Period ^b	-0.2	-0.4	-0.1	0.0	0.0	0.0	0.1	0.0	-0.1	0.0	-0.1	0.1
Water Year Types ^c												
Wet (32%)	-0.2	-0.3	0.0	0.0	0.0	0.1	0.0	0.1	0.0	0.0	0.0	0.8
Above Normal (16%)	0.0	-0.4	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.1	0.8
Below Normal (13%)	-0.4	-0.6	-0.4	-0.1	0.0	-0.1	0.2	0.3	0.0	0.0	0.0	-0.3
Dry (24%)	-0.1	-0.4	-0.2	-0.1	0.0	0.0	0.0	0.0	-0.1	0.0	-0.1	-0.2
Critical (15%)	-0.6	-0.1	0.1	0.2	0.1	0.0	0.1	0.0	-0.1	-0.1	-0.6	-1.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-5-3. Sacramento River below Keswick, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	60	56	53	50	48	49	49	51	52	54	55	58
20%	56	56	53	49	48	48	49	50	51	53	54	55
30%	55	56	52	49	47	48	49	50	50	52	53	54
40%	55	56	52	48	47	48	49	49	50	51	53	53
50%	55	55	51	48	47	47	48	49	50	51	52	53
60%	54	55	51	47	46	47	48	49	49	51	52	52
70%	54	55	51	47	46	46	47	49	49	50	52	51
80%	54	54	50	47	45	46	47	48	49	50	51	51
90%	54	54	49	46	45	45	46	48	48	49	51	51
Long Term												
Full Simulation Period ^b	55	55	51	48	46	47	48	49	50	51	53	54
Water Year Types ^c												
Wet (32%)	53	53	49	47	46	46	48	49	49	51	52	51
Above Normal (16%)	55	55	51	47	46	46	48	49	49	50	51	51
Below Normal (13%)	55	55	52	48	47	48	48	49	50	51	52	53
Dry (24%)	55	55	52	48	47	48	49	49	50	52	53	54
Critical (15%)	58	56	52	48	47	48	49	51	52	54	58	61

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	60	56	53	50	48	49	50	51	52	54	55	59
20%	56	56	53	49	48	48	49	50	51	53	54	55
30%	55	56	52	49	47	48	49	50	50	52	53	54
40%	55	55	52	48	47	48	49	49	50	51	53	53
50%	54	55	51	48	47	47	48	49	50	51	52	53
60%	54	55	51	47	46	47	48	49	49	51	52	52
70%	54	55	51	47	46	46	47	49	49	50	52	51
80%	54	54	50	47	45	46	47	48	49	50	51	51
90%	54	54	49	46	44	45	46	48	48	49	51	51
Long Term												
Full Simulation Period ^b	55	55	51	48	46	47	48	49	50	51	53	54
Water Year Types ^c												
Wet (32%)	53	53	49	47	46	46	48	49	49	51	52	51
Above Normal (16%)	55	55	51	47	46	46	48	49	49	50	51	51
Below Normal (13%)	54	55	52	48	47	48	48	49	50	51	52	53
Dry (24%)	55	55	52	48	47	48	49	49	50	51	53	54
Critical (15%)	58	56	52	48	47	48	49	51	53	54	58	61

Alternative 5 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.1	0.0	0.0	0.2	0.0	0.0	0.2	0.0	0.0	-0.1	0.0	0.9
0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-0.1	-0.1	-0.1
0.3	0.1	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1
0.4	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0
0.5	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0
0.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
0.7	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
0.8	-0.1	0.0	0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
0.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.1	0.1
Dry (24%)	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	-0.1	-0.1	-0.1
Critical (15%)	0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-0.1	-0.1	0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-5-4. Sacramento River below Keswick, Monthly Temperature

Second Basis of Comparison		Monthly Temperature (DEG-F)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
10%	58	56	53	50	48	49	49	51	52	54	55	56	
20%	56	56	52	49	48	48	49	50	51	52	54	55	
30%	55	56	52	49	47	48	49	50	50	52	53	54	
40%	55	55	51	48	47	48	49	49	50	51	53	54	
50%	54	55	51	48	47	47	48	49	50	51	52	53	
60%	54	54	51	47	46	47	48	49	49	51	52	53	
70%	54	54	51	47	46	46	47	49	49	50	52	52	
80%	54	54	50	47	45	46	47	48	49	50	51	52	
90%	53	53	49	46	45	45	46	48	48	50	51	51	
Long Term													
Full Simulation Period ^b	55	55	51	48	46	47	48	49	50	51	53	54	
Water Year Types ^c													
Wet (32%)	52	52	49	47	46	46	48	49	49	51	52	52	
Above Normal (16%)	55	54	51	47	46	46	48	49	49	50	51	52	
Below Normal (13%)	54	55	51	48	47	48	49	49	50	51	52	53	
Dry (24%)	55	55	51	48	47	48	49	49	50	51	53	54	
Critical (15%)	57	56	52	48	47	48	49	51	52	54	57	60	

No Action Alternative		Monthly Temperature (DEG-F)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
10%	60	56	53	50	48	49	49	51	52	54	55	58	
20%	56	56	53	49	48	48	49	50	51	53	54	55	
30%	55	56	52	49	47	48	49	50	50	52	53	54	
40%	55	56	52	48	47	48	49	49	50	51	53	53	
50%	55	55	51	48	47	47	48	49	50	51	52	53	
60%	54	55	51	47	46	47	48	49	49	51	52	52	
70%	54	55	51	47	46	46	47	49	49	50	52	51	
80%	54	54	50	47	45	46	47	48	49	50	51	51	
90%	54	54	49	46	45	45	46	48	48	49	51	51	
Long Term													
Full Simulation Period ^b	55	55	51	48	46	47	48	49	50	51	53	54	
Water Year Types ^c													
Wet (32%)	53	53	49	47	46	46	48	49	49	51	52	51	
Above Normal (16%)	55	55	51	47	46	46	48	49	49	50	51	51	
Below Normal (13%)	55	55	52	48	47	48	48	49	50	51	52	53	
Dry (24%)	55	55	52	48	47	48	49	49	50	52	53	54	
Critical (15%)	58	56	52	48	47	48	49	51	52	54	58	61	

No Action Alternative minus Second Basis of Comparison		Monthly Temperature (DEG-F)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
0.1	2.0	0.3	0.1	0.0	-0.2	0.0	0.0	0.0	0.4	0.1	-0.1	1.9	
0.2	0.1	0.1	0.2	0.0	-0.2	0.0	0.0	0.1	0.2	0.3	0.3	0.2	
0.3	-0.1	0.2	0.4	0.0	0.0	0.0	0.1	0.1	0.2	0.0	0.1	0.1	
0.4	0.1	0.4	0.4	0.0	0.0	0.1	0.0	-0.1	0.0	0.1	0.1	-0.6	
0.5	0.1	0.4	0.2	0.0	0.0	0.0	0.0	0.0	0.0	-0.2	-0.1	-0.3	
0.6	0.0	0.6	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	-0.2	0.0	-0.7	
0.7	0.1	0.7	0.0	0.0	-0.1	-0.2	0.0	0.0	0.0	-0.1	0.1	-0.9	
0.8	0.2	0.5	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	-0.8	
0.9	0.4	0.3	-0.1	-0.1	-0.1	0.0	0.0	0.0	0.0	-0.1	0.0	-0.5	
Long Term													
Full Simulation Period ^b	0.2	0.4	0.1	0.0	0.0	0.0	-0.1	0.0	0.1	0.0	0.1	-0.2	
Water Year Types ^c													
Wet (32%)	0.2	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-1.0	
Above Normal (16%)	0.1	0.4	0.1	0.0	-0.1	0.0	-0.1	0.0	0.0	-0.2	0.0	-0.8	
Below Normal (13%)	0.3	0.6	0.5	0.1	0.0	0.1	-0.2	-0.3	0.0	0.0	0.2	-0.1	
Dry (24%)	-0.1	0.3	0.2	0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.1	
Critical (15%)	0.8	0.2	0.0	-0.3	-0.2	-0.1	-0.1	0.0	0.2	0.1	0.5	1.1	

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-5-5. Sacramento River below Keswick, Monthly Temperature

Second Basis of Comparison		Monthly Temperature (DEG-F)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	58	56	53	50	48	49	49	51	52	54	55	56	
20%	56	56	52	49	48	48	49	50	51	52	54	55	
30%	55	56	52	49	47	48	49	50	50	52	53	54	
40%	55	55	51	48	47	48	49	49	50	51	53	54	
50%	54	55	51	48	47	47	48	49	50	51	52	53	
60%	54	54	51	47	46	47	48	49	49	51	52	53	
70%	54	54	51	47	46	46	47	49	49	50	52	52	
80%	54	54	50	47	45	46	47	48	49	50	51	52	
90%	53	53	49	46	45	45	46	48	48	50	51	51	
Long Term													
Full Simulation Period ^b	55	55	51	48	46	47	48	49	50	51	53	54	
Water Year Types^c													
Wet (32%)	52	52	49	47	46	46	48	49	49	51	52	52	
Above Normal (16%)	55	54	51	47	46	46	48	49	49	50	51	52	
Below Normal (13%)	54	55	51	48	47	48	49	49	50	51	52	53	
Dry (24%)	55	55	51	48	47	48	49	49	50	51	53	54	
Critical (15%)	57	56	52	48	47	48	49	51	52	54	57	60	

Alternative 3		Monthly Temperature (DEG-F)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	58	56	53	50	48	49	50	51	52	54	55	56	
20%	55	56	52	49	48	48	49	50	51	52	54	54	
30%	55	56	52	49	47	48	49	50	50	52	53	54	
40%	55	55	51	48	47	48	49	49	50	51	53	53	
50%	54	55	51	48	47	47	48	49	50	51	52	53	
60%	54	54	51	47	46	47	48	49	49	51	52	53	
70%	54	54	51	47	46	46	47	49	49	50	52	52	
80%	54	54	50	47	45	46	47	48	49	50	51	52	
90%	53	53	49	46	45	45	46	48	48	49	51	51	
Long Term													
Full Simulation Period ^b	55	55	51	48	46	47	48	49	50	51	53	54	
Water Year Types^c													
Wet (32%)	52	53	49	47	46	46	48	49	49	51	52	52	
Above Normal (16%)	55	54	51	47	46	46	48	49	49	50	51	52	
Below Normal (13%)	54	55	52	48	47	48	49	49	50	51	52	53	
Dry (24%)	55	55	51	48	47	48	49	49	50	51	53	54	
Critical (15%)	57	56	52	48	47	48	49	51	52	54	57	60	

Alternative 3 minus Second Basis of Comparison		Monthly Temperature (DEG-F)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
0.1	-0.1	0.0	0.1	0.1	0.0	0.0	0.1	-0.2	0.1	-0.1	-0.2	0.1	
0.2	-0.1	0.0	-0.1	0.0	0.0	0.1	0.1	0.0	0.0	0.0	-0.1	-0.1	
0.3	-0.1	0.0	0.1	0.0	-0.1	0.0	0.1	0.0	0.0	0.0	0.0	0.0	
0.4	-0.1	0.2	0.1	0.0	0.0	0.0	0.1	0.0	0.1	0.0	0.2	-0.2	
0.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	-0.1	
0.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
0.7	0.0	0.1	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.3	
0.8	-0.1	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.1	0.0	
0.9	0.0	0.0	0.1	0.1	-0.1	0.0	0.0	0.1	0.0	-0.1	0.1	0.0	
Long Term													
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	
Water Year Types^c													
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	
Above Normal (16%)	0.0	0.0	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	
Below Normal (13%)	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.2	-0.3	
Dry (24%)	-0.2	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.2	-0.1	
Critical (15%)	0.2	0.1	0.0	0.0	-0.1	-0.1	0.0	0.0	0.0	0.1	0.0	0.0	

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-5-6. Sacramento River below Keswick, Monthly Temperature

Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	58	56	53	50	48	49	49	51	52	54	55	56
20%	56	56	52	49	48	48	49	50	51	52	54	55
30%	55	56	52	49	47	48	49	50	50	52	53	54
40%	55	55	51	48	47	48	49	49	50	51	53	54
50%	54	55	51	48	47	47	48	49	50	51	52	53
60%	54	54	51	47	46	47	48	49	49	51	52	53
70%	54	54	51	47	46	46	47	49	49	50	52	52
80%	54	54	50	47	45	46	47	48	49	50	51	52
90%	53	53	49	46	45	45	46	48	48	50	51	51
Long Term												
Full Simulation Period ^b	55	55	51	48	46	47	48	49	50	51	53	54
Water Year Types ^c												
Wet (32%)	52	52	49	47	46	46	48	49	49	51	52	52
Above Normal (16%)	55	54	51	47	46	46	48	49	49	50	51	52
Below Normal (13%)	54	55	51	48	47	48	49	49	50	51	52	53
Dry (24%)	55	55	51	48	47	48	49	49	50	51	53	54
Critical (15%)	57	56	52	48	47	48	49	51	52	54	57	60

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	60	56	53	50	48	49	50	51	52	54	55	59
20%	56	56	53	49	48	48	49	50	51	53	54	55
30%	55	56	52	49	47	48	49	50	50	52	53	54
40%	55	55	52	48	47	48	49	49	50	51	53	53
50%	54	55	51	48	47	47	48	49	50	51	52	53
60%	54	55	51	47	46	47	48	49	49	51	52	52
70%	54	55	51	47	46	46	47	49	49	50	52	51
80%	54	54	50	47	45	46	47	48	49	50	51	51
90%	54	54	49	46	44	45	46	48	48	49	51	51
Long Term												
Full Simulation Period ^b	55	55	51	48	46	47	48	49	50	51	53	54
Water Year Types ^c												
Wet (32%)	53	53	49	47	46	46	48	49	49	51	52	51
Above Normal (16%)	55	55	51	47	46	46	48	49	49	50	51	51
Below Normal (13%)	54	55	52	48	47	48	48	49	50	51	52	53
Dry (24%)	55	55	52	48	47	48	49	49	50	51	53	54
Critical (15%)	58	56	52	48	47	48	49	51	53	54	58	61

Alternative 5 minus Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	2.1	0.3	0.1	0.2	-0.2	0.0	0.2	0.0	0.4	0.0	0.0	2.8
0.2	0.1	0.1	0.2	0.0	-0.2	0.0	0.0	0.1	0.1	0.1	0.2	0.1
0.3	0.0	0.2	0.4	0.0	-0.1	0.0	0.1	0.1	0.1	0.0	0.2	0.0
0.4	0.0	0.3	0.4	0.0	-0.1	0.1	0.0	-0.1	0.0	0.0	0.0	-0.5
0.5	0.1	0.4	0.1	0.0	0.1	0.0	0.0	0.0	0.0	-0.2	-0.2	-0.3
0.6	0.0	0.6	0.0	0.0	0.1	0.0	0.0	-0.1	0.0	-0.1	0.0	-0.7
0.7	0.1	0.7	0.0	-0.1	-0.1	-0.2	0.0	0.0	0.0	-0.1	0.1	-0.9
0.8	0.1	0.5	0.2	0.0	0.0	-0.1	-0.1	0.0	0.0	0.0	0.0	-0.8
0.9	0.4	0.2	-0.1	0.0	-0.1	0.0	0.0	0.1	0.0	-0.1	0.0	-0.5
Long Term												
Full Simulation Period ^b	0.2	0.4	0.1	0.0	-0.1	0.0	0.0	0.0	0.1	0.0	0.1	-0.2
Water Year Types ^c												
Wet (32%)	0.2	0.3	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.1	-0.9
Above Normal (16%)	0.1	0.3	0.1	0.0	-0.1	0.0	-0.1	0.0	0.0	-0.2	-0.1	-0.8
Below Normal (13%)	0.3	0.6	0.5	0.1	0.0	0.1	-0.1	-0.2	0.0	0.0	0.3	0.0
Dry (24%)	0.0	0.3	0.2	0.1	0.0	0.0	0.0	0.1	0.1	0.0	-0.2	0.0
Critical (15%)	0.9	0.3	0.0	-0.3	-0.2	-0.1	0.0	0.0	0.2	0.0	0.4	1.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


B.6. Sacramento River at Balls Ferry Temperature

Figure B-6-1. Sacramento River at Balls Ferry, October

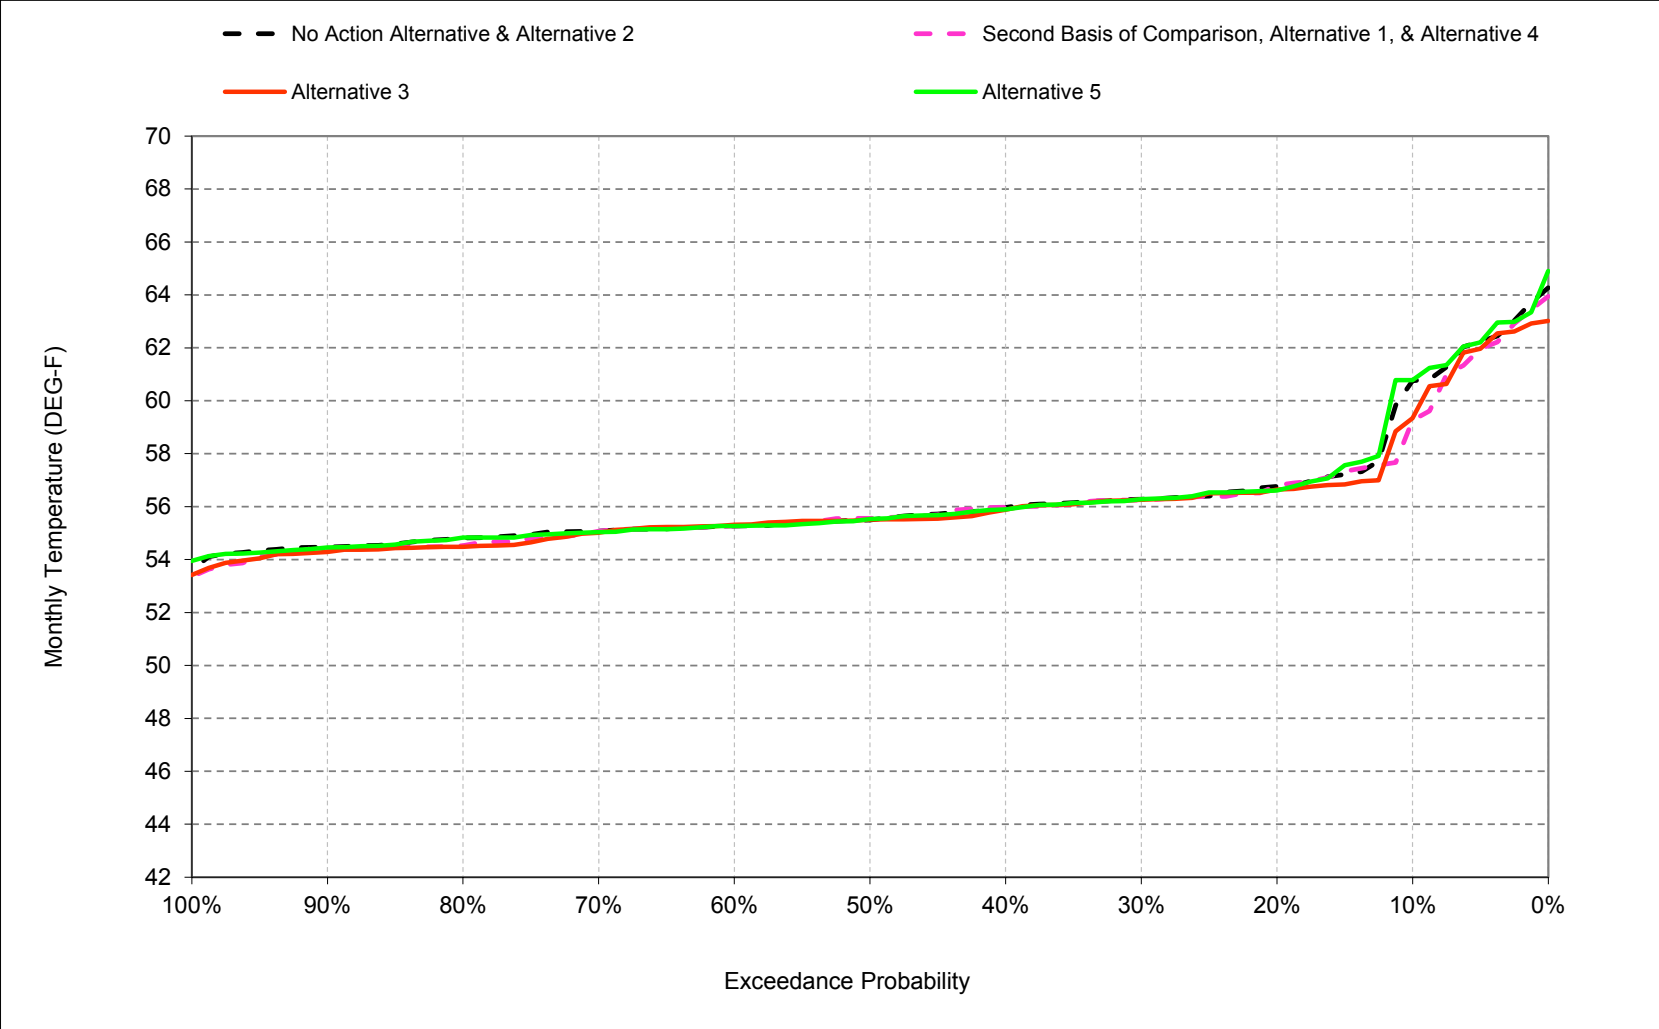


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-6-2. Sacramento River at Balls Ferry, November

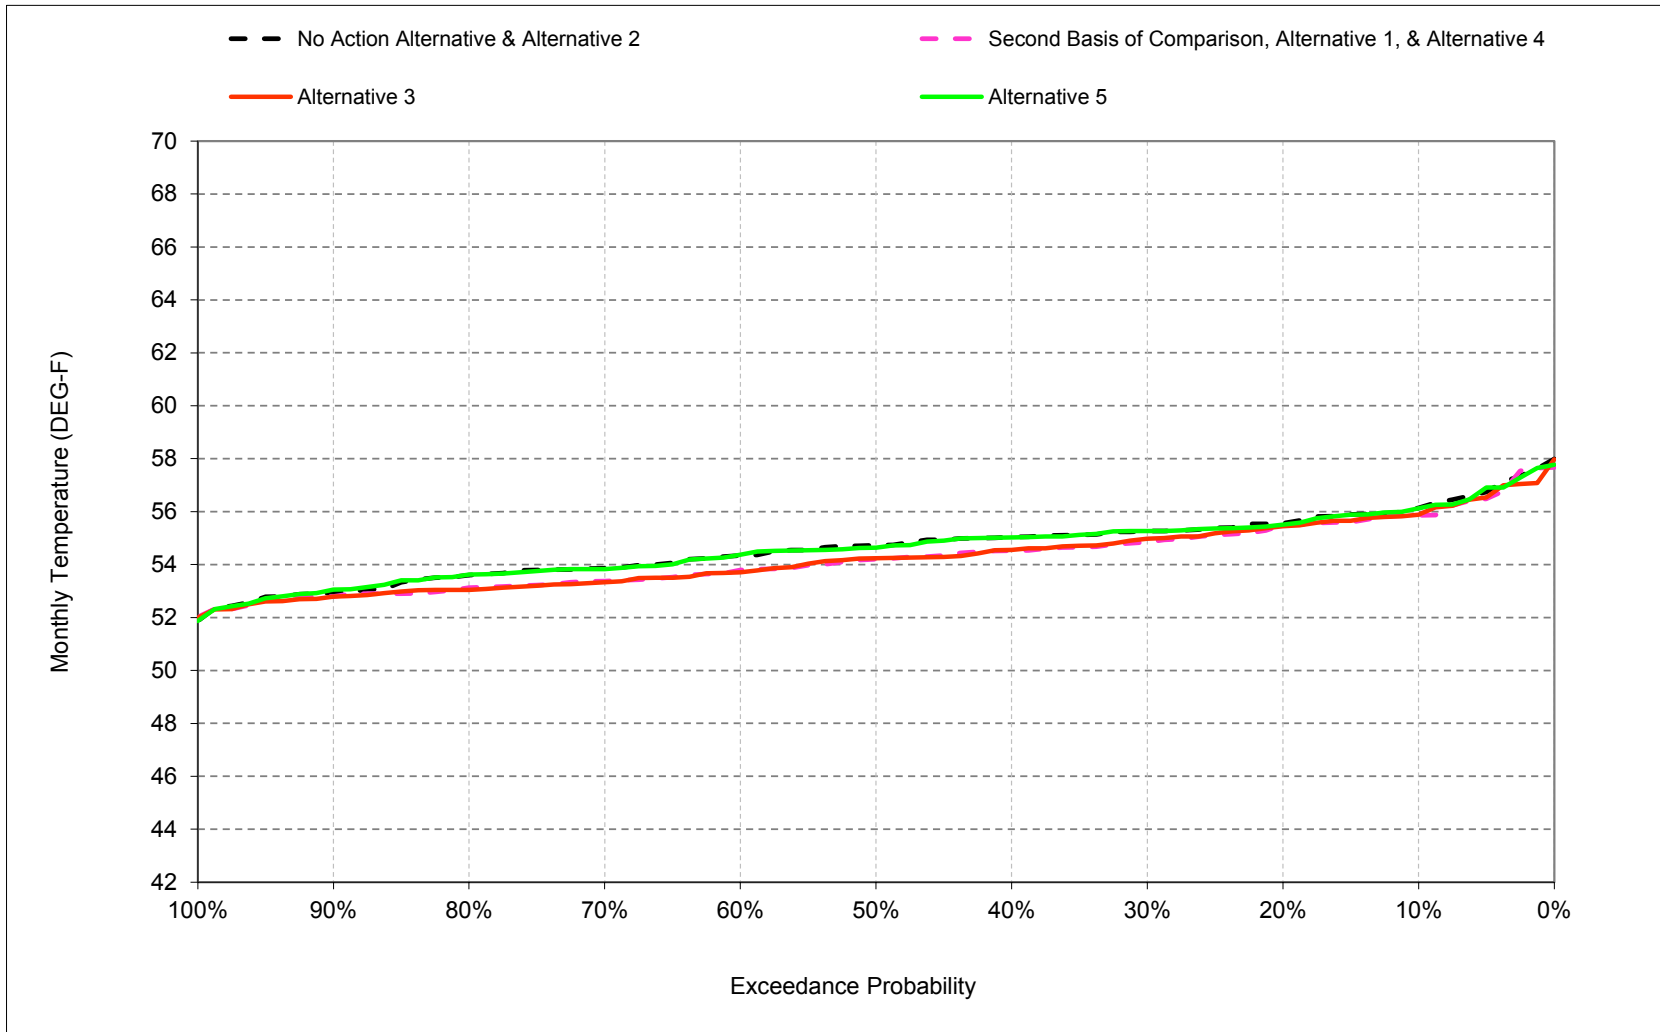


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-6-3. Sacramento River at Balls Ferry, December

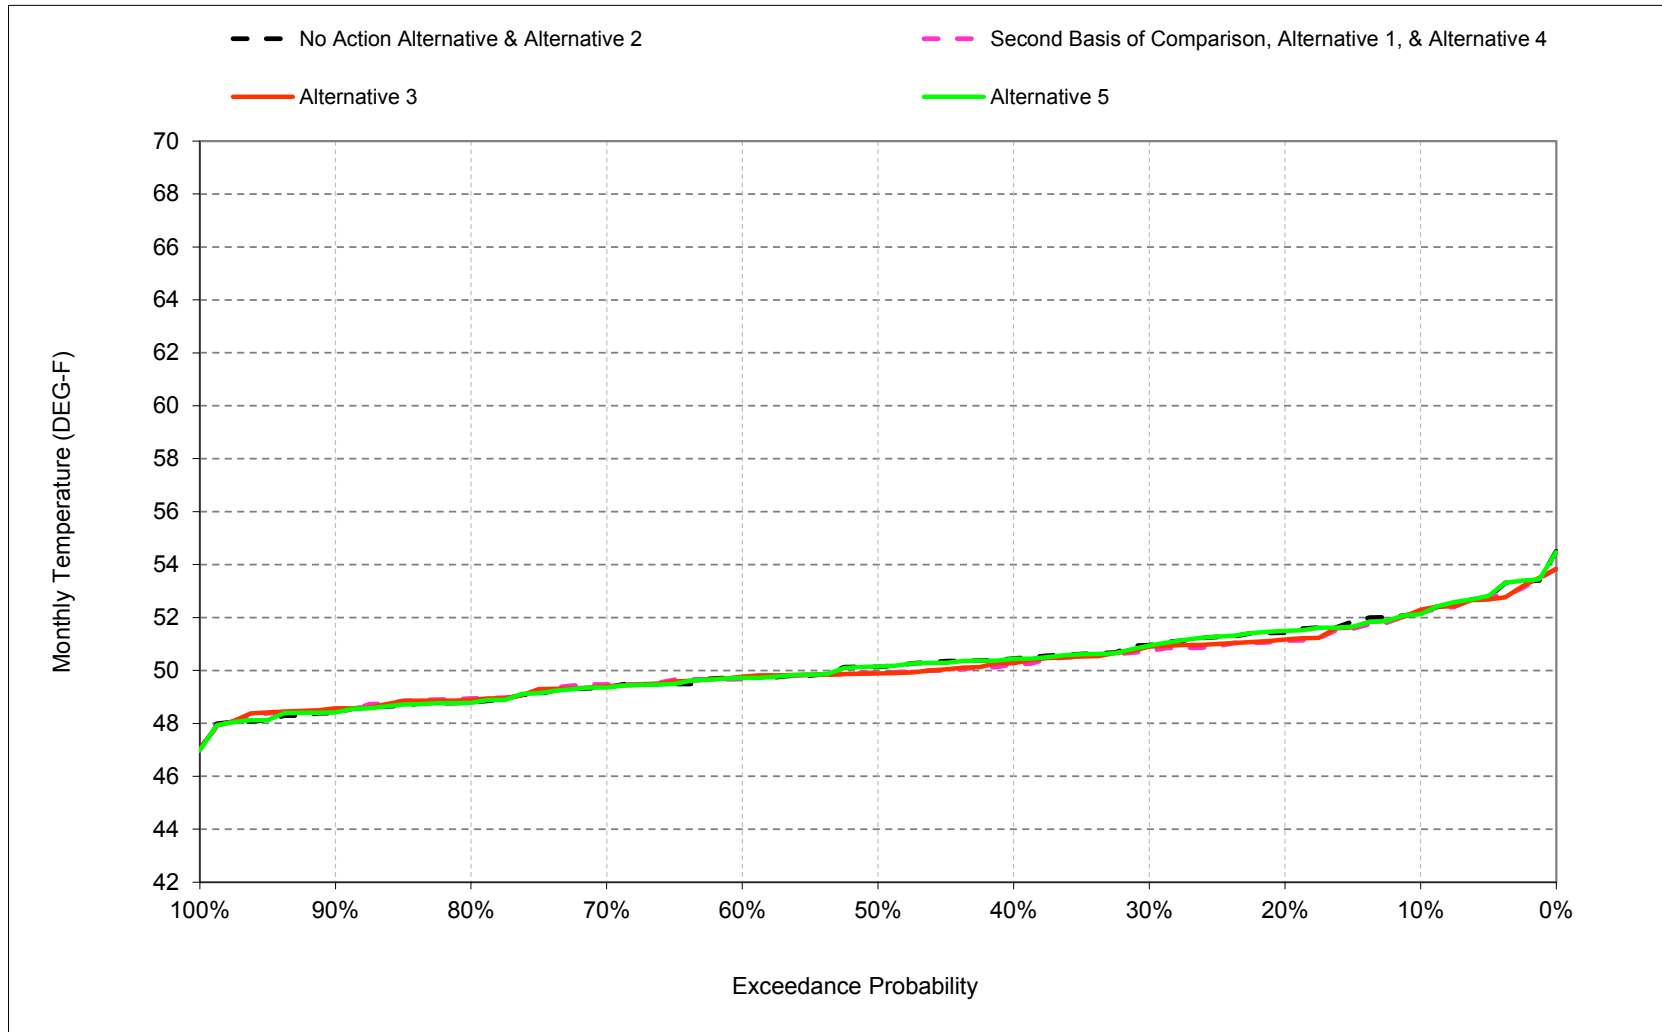


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-6-4. Sacramento River at Balls Ferry, January

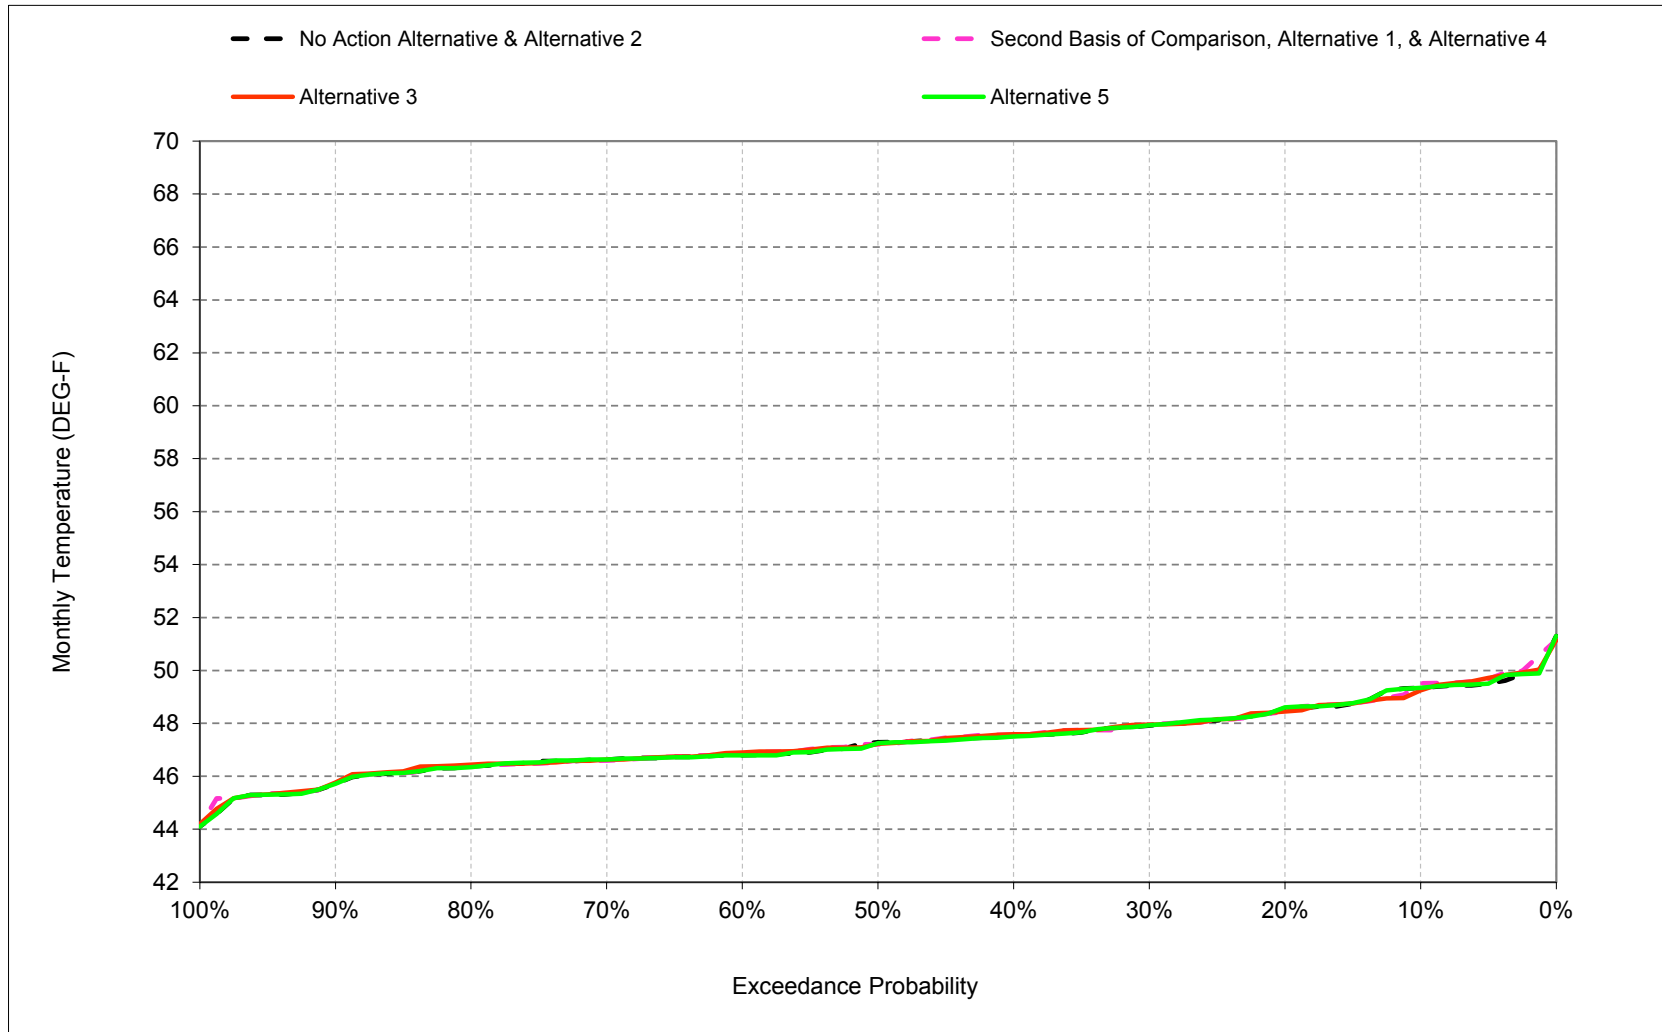


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-6-5. Sacramento River at Balls Ferry, February

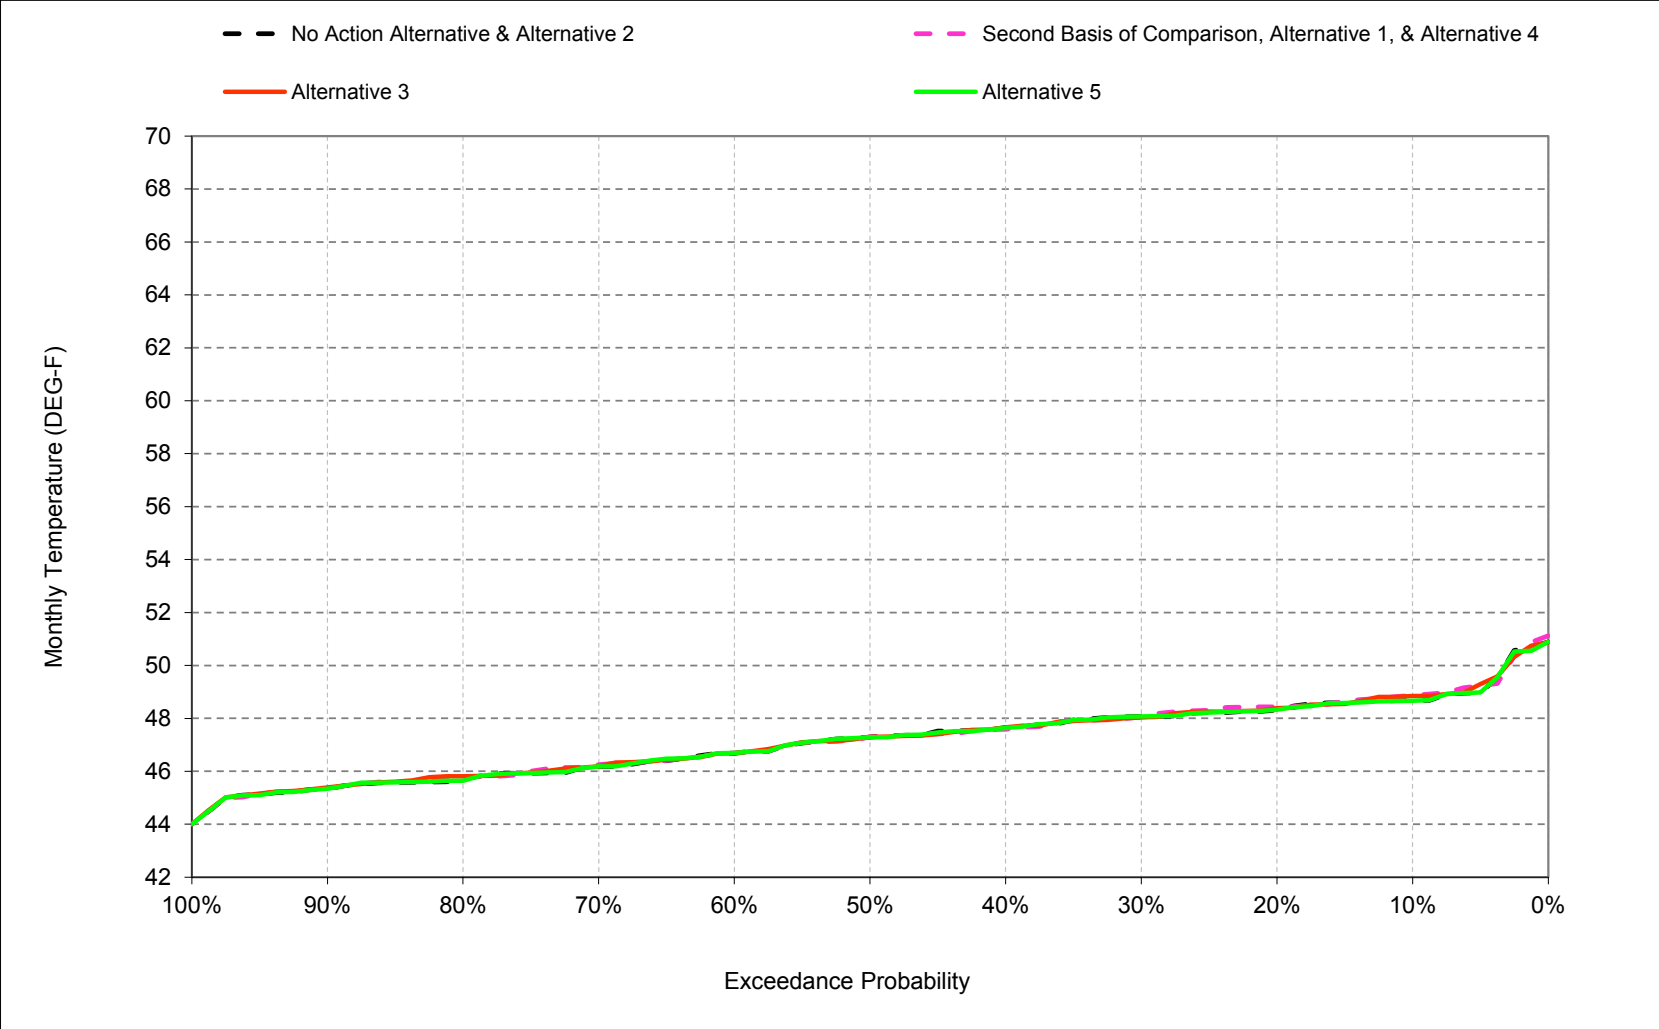


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-6-6. Sacramento River at Balls Ferry, March

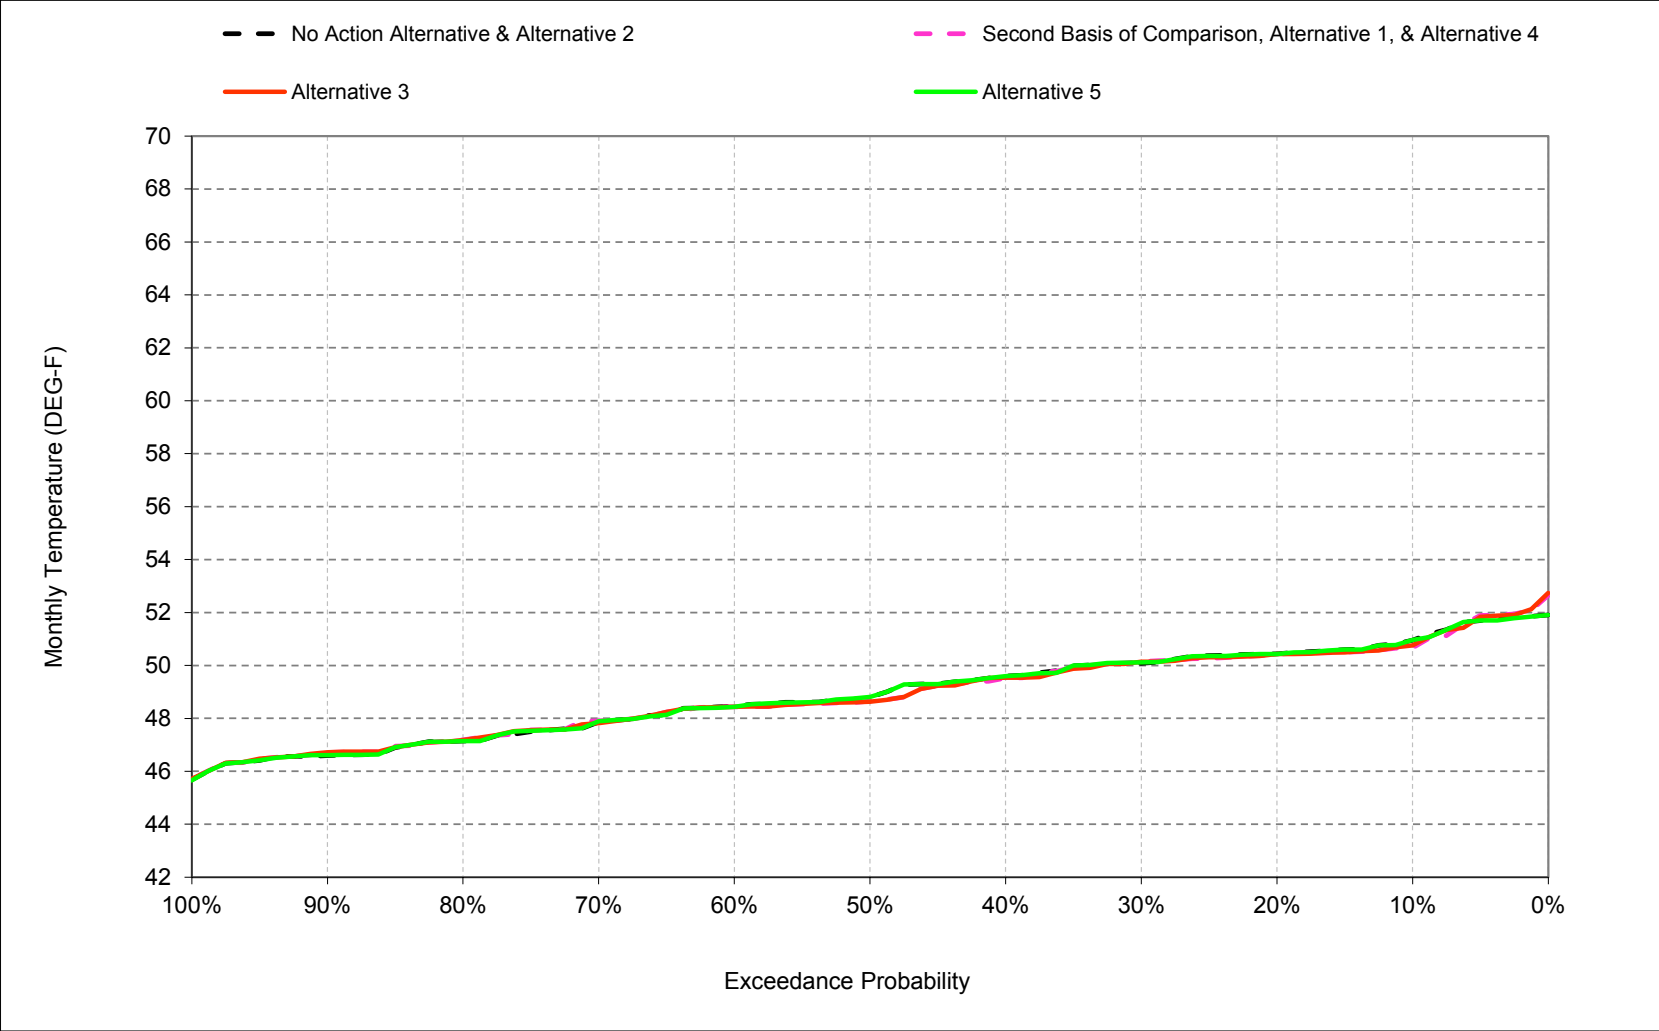


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-6-7. Sacramento River at Balls Ferry, April

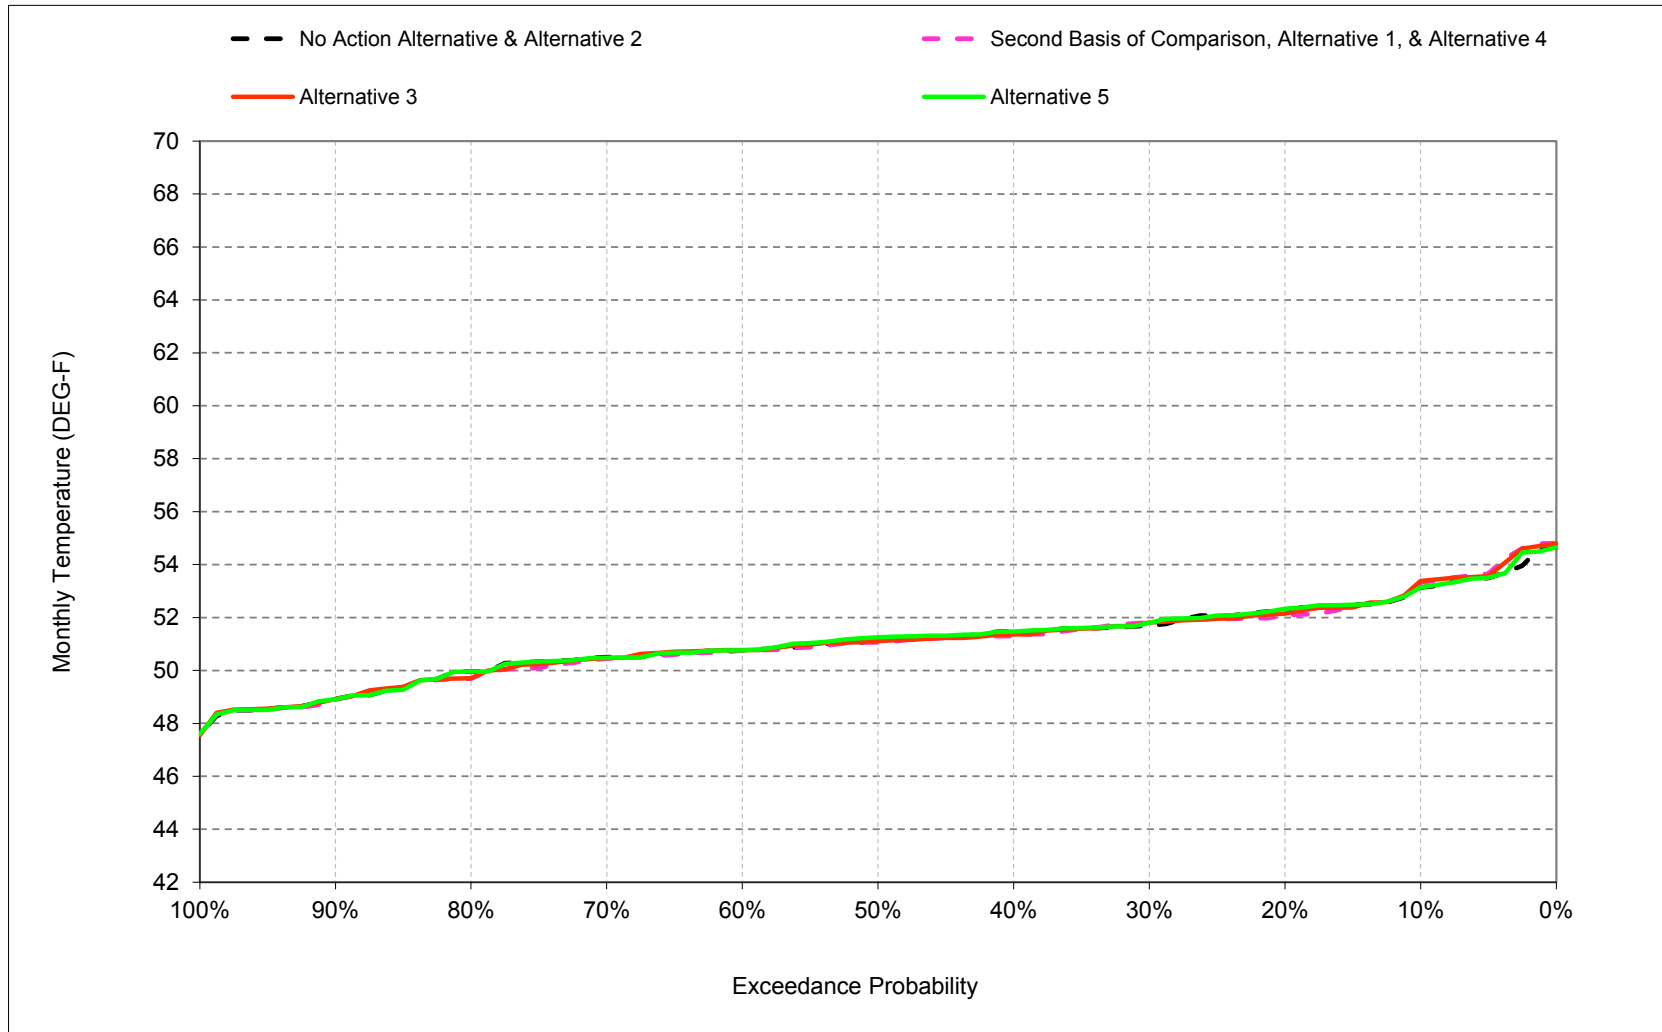


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-6-8. Sacramento River at Balls Ferry, May

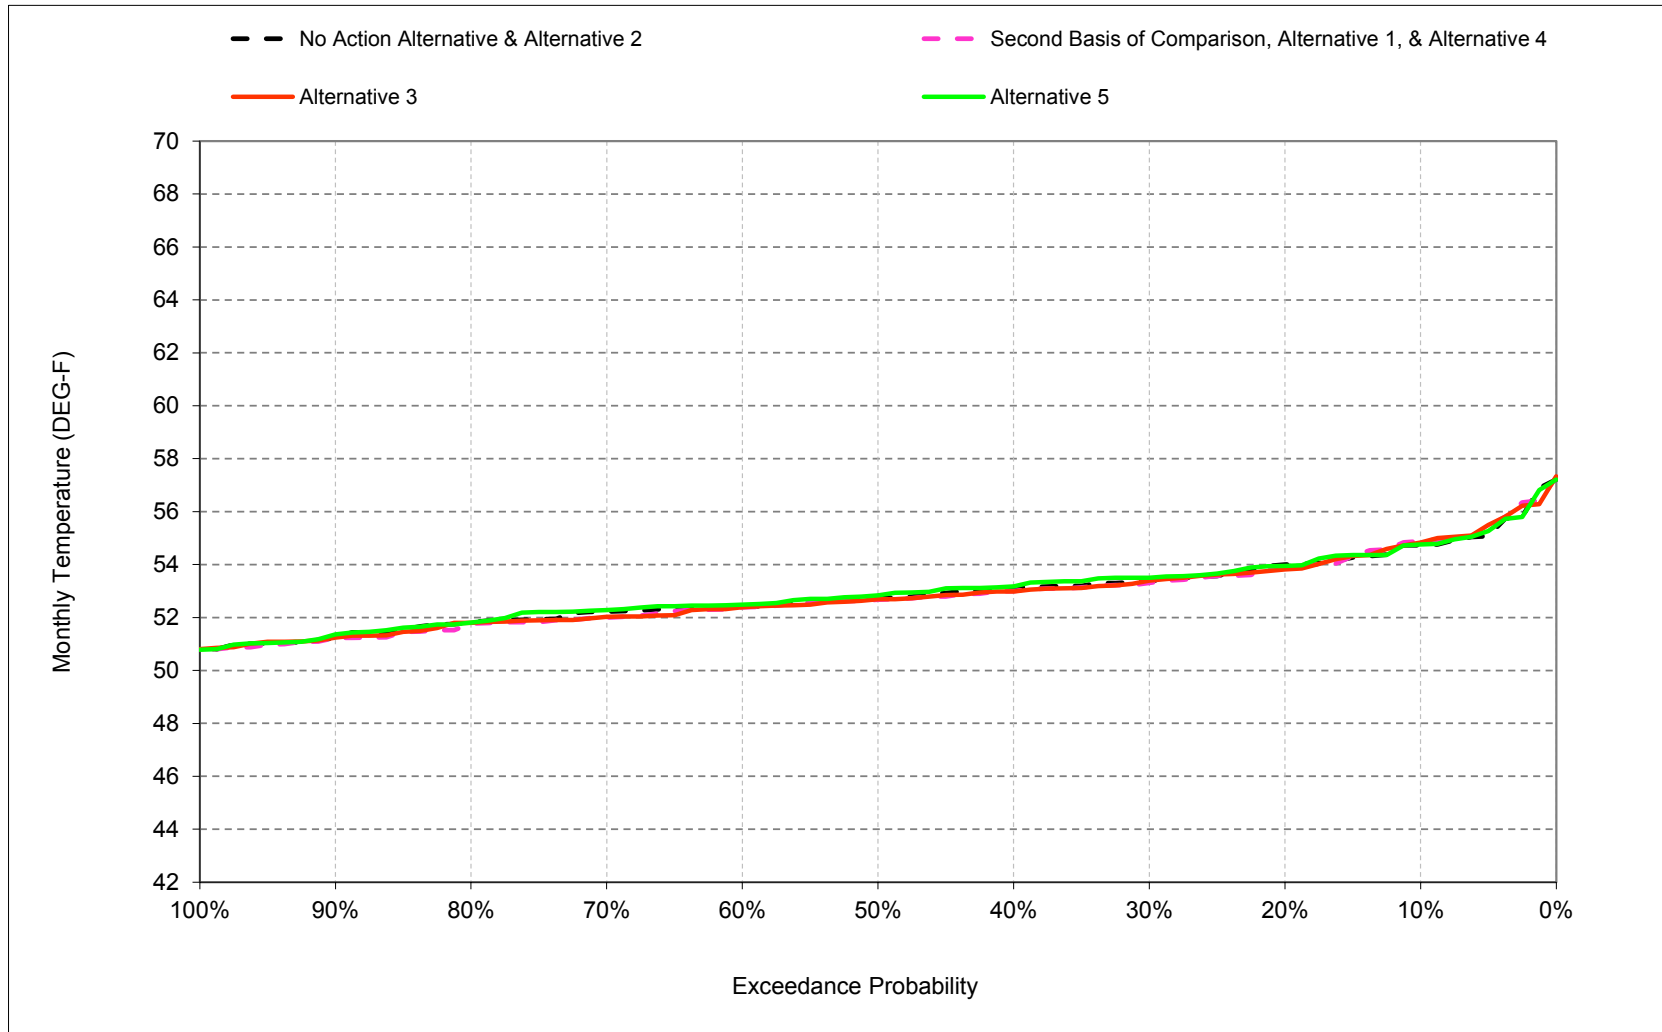


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-6-9. Sacramento River at Balls Ferry, June

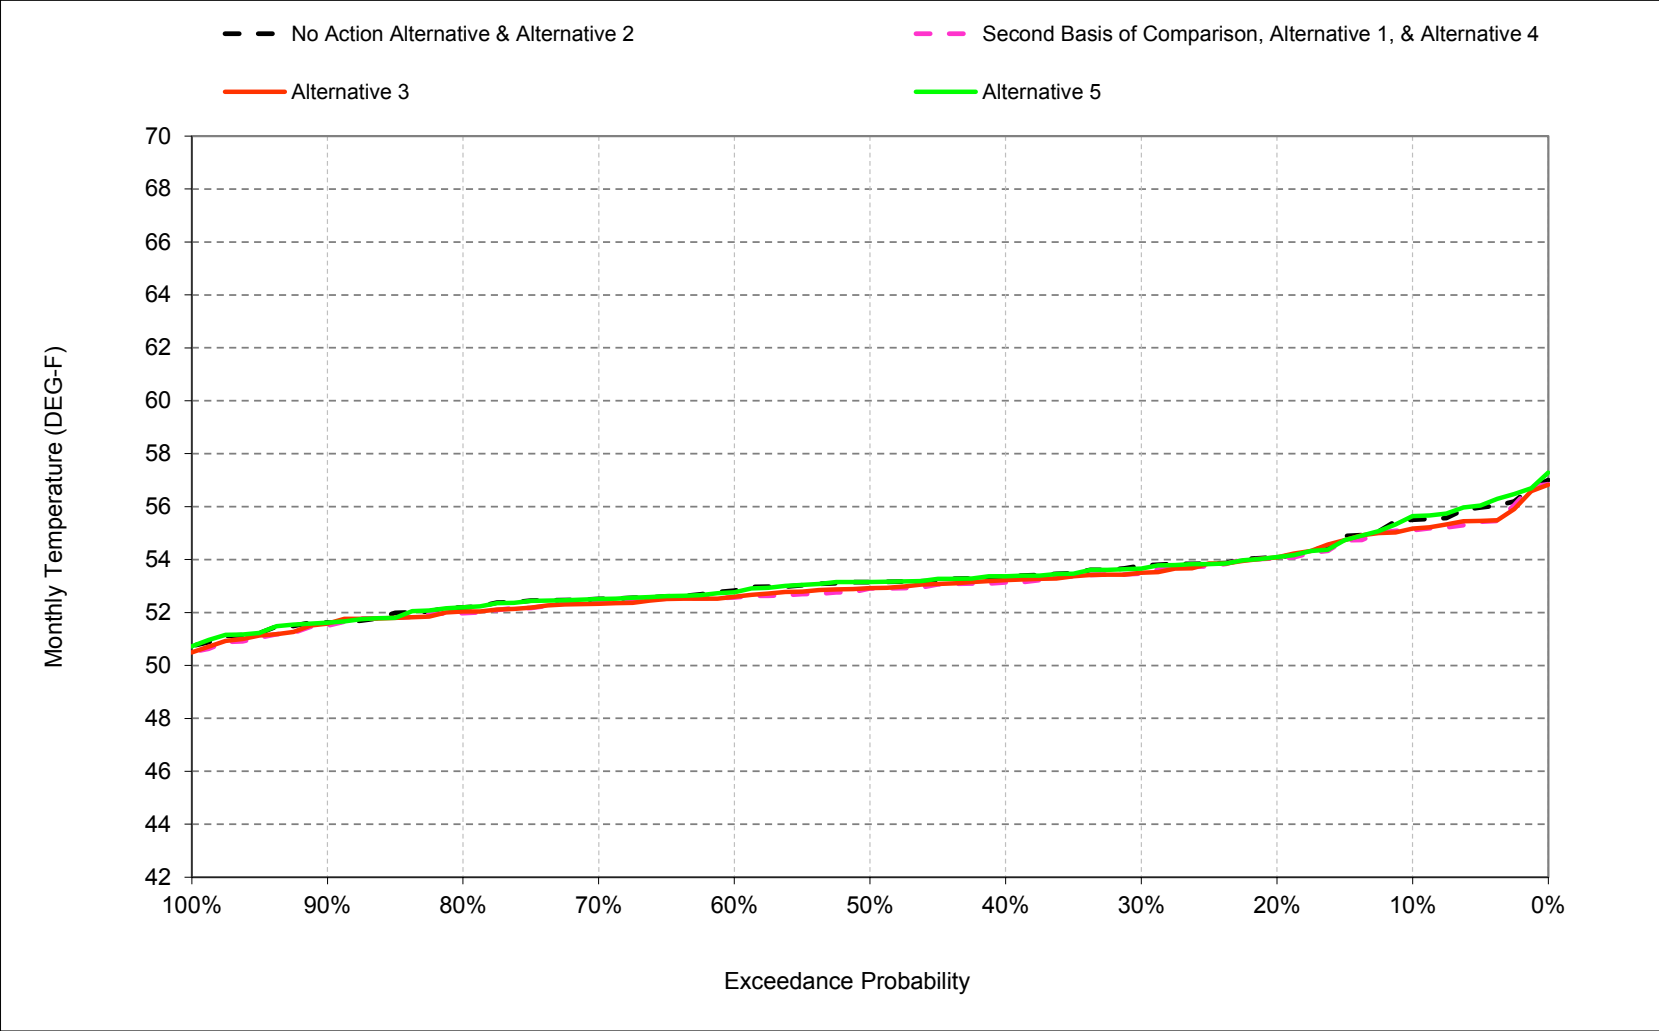


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-6-10. Sacramento River at Balls Ferry, July

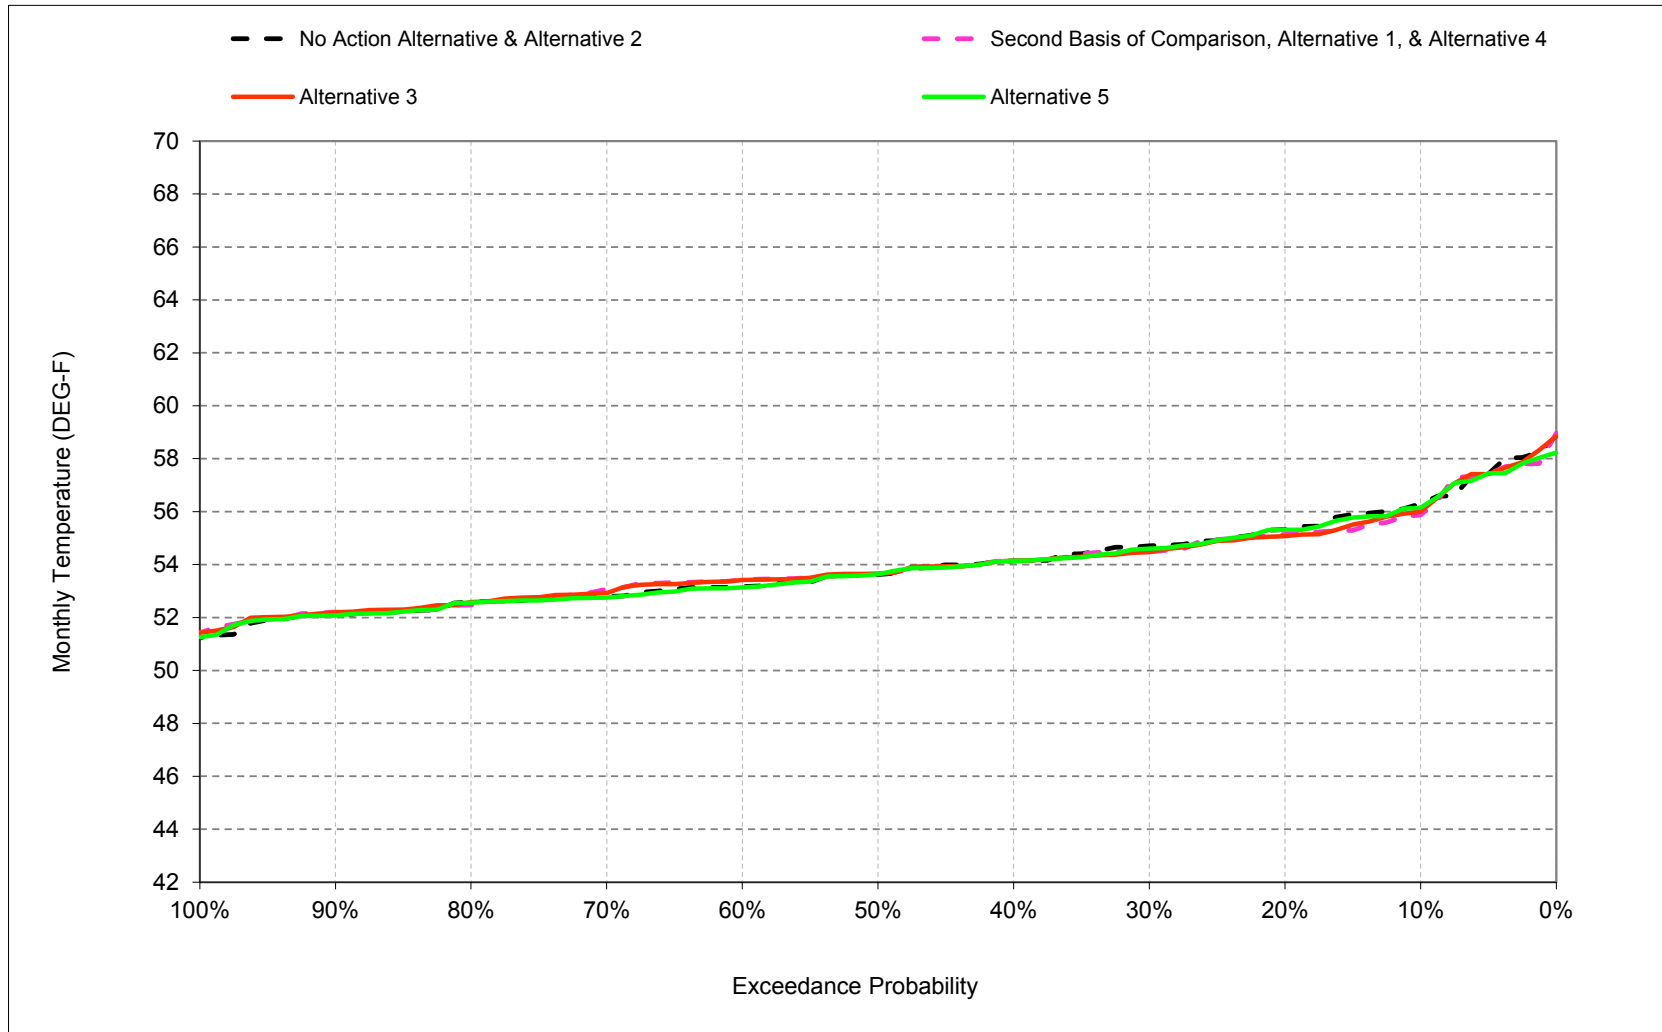


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-6-11. Sacramento River at Balls Ferry, August

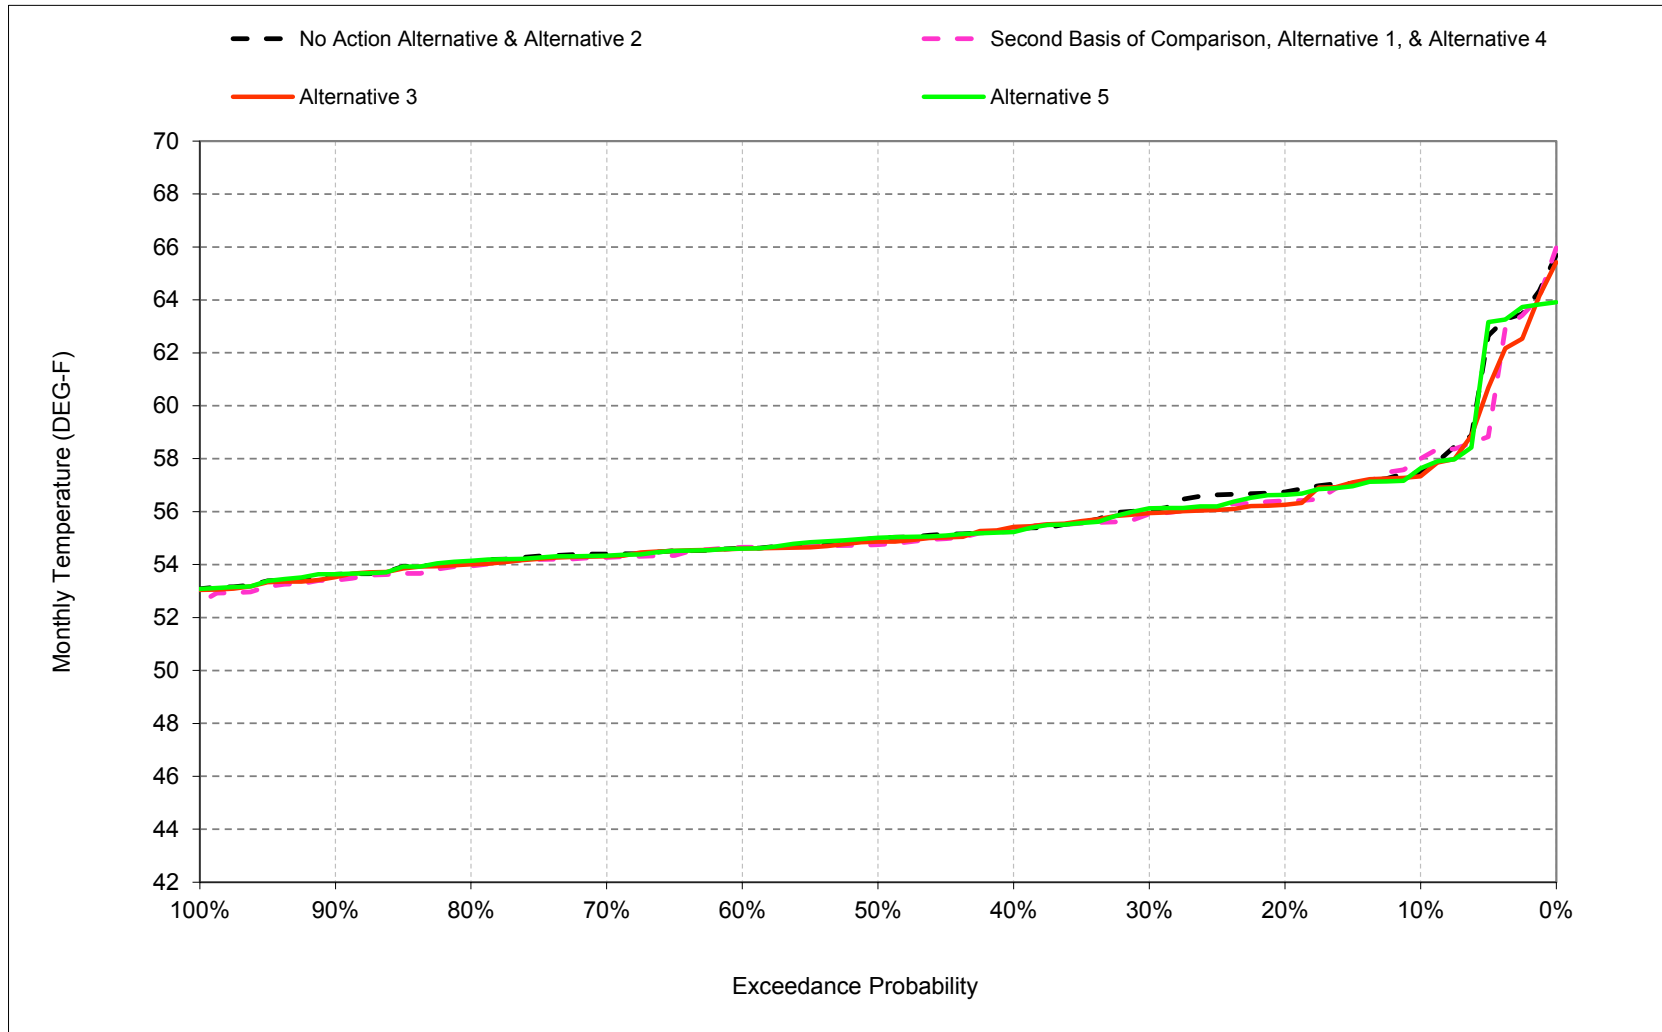

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-6-12. Sacramento River at Balls Ferry, September

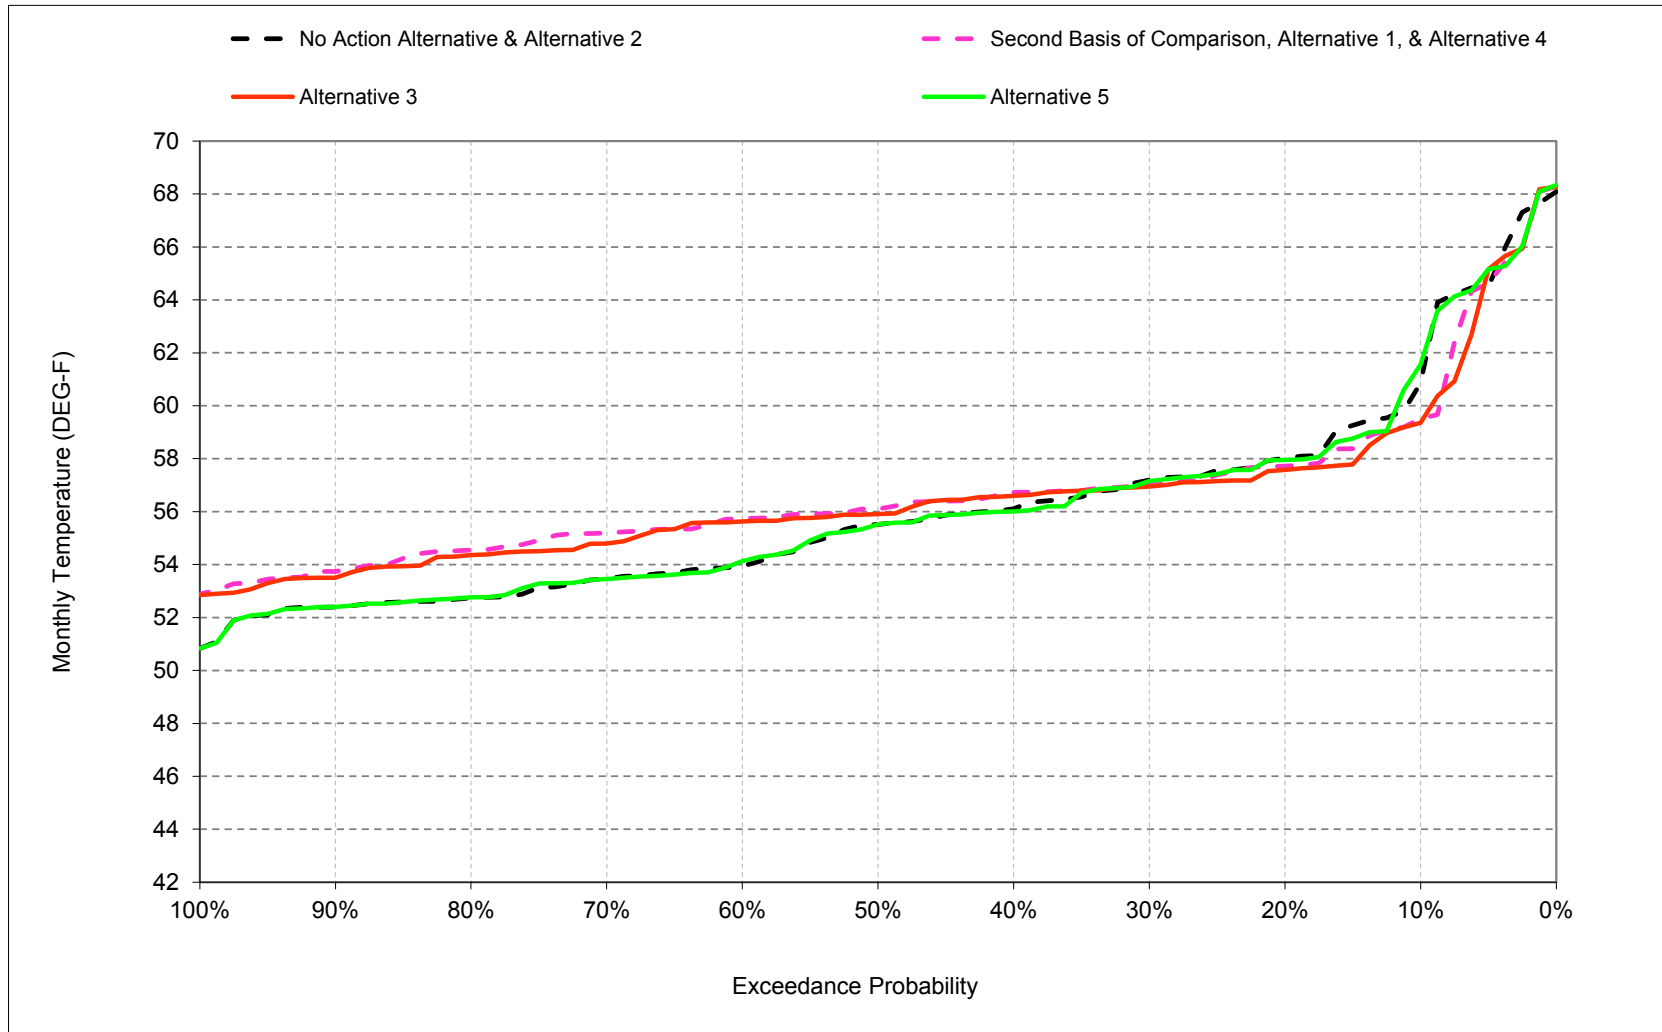

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-6-1. Sacramento River at Balls Ferry, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	56	52	49	49	51	53	55	55	56	57	61
20%	57	56	51	49	48	50	52	54	54	55	57	58
30%	56	55	51	48	48	50	52	53	54	55	56	57
40%	56	55	50	48	48	50	51	53	53	54	55	56
50%	55	55	50	47	47	49	51	53	53	54	55	55
60%	55	54	50	47	47	48	51	52	53	53	55	54
70%	55	54	49	47	46	48	50	52	52	53	54	53
80%	55	54	49	46	46	47	50	52	52	53	54	53
90%	54	53	48	46	45	47	49	51	52	52	53	52
Long Term												
Full Simulation Period ^b	56	55	50	47	47	49	51	53	53	54	56	56
Water Year Types ^c												
Wet (32%)	53	52	48	47	46	47	50	53	53	53	54	53
Above Normal (16%)	56	54	50	47	46	48	51	53	52	52	54	54
Below Normal (13%)	56	55	51	47	47	50	51	52	53	53	55	56
Dry (24%)	56	55	50	48	48	50	52	53	53	54	56	57
Critical (15%)	59	56	51	48	48	50	51	54	55	57	60	63

Alternative 1												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	59	56	52	49	49	51	53	55	55	56	58	59
20%	57	56	51	48	48	50	52	54	54	55	56	58
30%	56	55	51	48	48	50	52	53	53	54	56	57
40%	56	55	50	48	48	49	51	53	53	54	55	57
50%	56	54	50	47	47	49	51	53	53	54	55	56
60%	55	54	50	47	47	48	51	52	53	53	55	56
70%	55	53	49	47	46	48	50	52	52	53	54	55
80%	55	53	49	46	46	47	50	52	52	52	54	55
90%	54	53	48	46	45	47	49	51	51	52	53	54
Long Term												
Full Simulation Period ^b	56	54	50	47	47	49	51	53	53	54	55	57
Water Year Types ^c												
Wet (32%)	53	52	48	47	46	48	50	53	53	53	54	55
Above Normal (16%)	56	54	50	47	46	48	51	52	52	53	54	55
Below Normal (13%)	55	54	50	47	47	49	51	52	53	53	54	56
Dry (24%)	56	54	50	48	48	50	52	53	53	54	56	57
Critical (15%)	58	56	51	48	48	50	51	54	55	57	60	62

Alternative 1 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-1.5	-0.3	0.0	0.1	0.2	-0.3	0.2	0.1	-0.4	-0.4	0.5	-1.3
0.2	0.0	-0.1	-0.3	-0.1	0.1	0.0	-0.1	-0.1	0.0	-0.2	-0.3	-0.3
0.3	0.0	-0.4	-0.2	0.0	0.0	0.1	0.1	-0.1	-0.3	-0.2	-0.2	-0.2
0.4	0.0	-0.5	-0.2	0.1	0.0	-0.1	-0.2	-0.1	-0.2	0.0	-0.1	0.6
0.5	0.1	-0.5	-0.2	-0.1	0.0	-0.1	-0.1	-0.1	-0.3	0.0	-0.2	0.6
0.6	0.0	-0.5	0.0	0.0	0.0	0.0	0.0	-0.1	-0.2	0.2	0.0	1.7
0.7	0.0	-0.5	0.1	0.0	0.0	0.2	-0.1	-0.2	-0.1	0.2	-0.1	1.7
0.8	-0.3	-0.5	0.2	0.0	0.1	0.0	-0.3	-0.2	-0.2	-0.1	-0.1	1.8
0.9	0.0	-0.1	0.1	0.0	0.0	0.1	-0.1	0.0	-0.2	0.1	-0.1	1.3
Long Term												
Full Simulation Period ^b	-0.1	-0.4	-0.1	0.0	0.0	0.0	0.0	-0.1	-0.2	0.0	-0.2	0.7
Water Year Types ^c												
Wet (32%)	-0.1	-0.3	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	-0.2	2.0
Above Normal (16%)	0.0	-0.4	-0.1	0.1	0.0	-0.1	0.0	-0.2	-0.2	0.1	-0.1	1.5
Below Normal (13%)	-0.3	-0.6	-0.4	0.0	0.0	-0.2	0.0	0.0	-0.2	0.0	-0.3	0.0
Dry (24%)	0.0	-0.3	-0.2	-0.1	0.0	0.0	-0.1	-0.1	-0.3	-0.1	0.1	-0.1
Critical (15%)	-0.6	-0.3	0.0	0.2	0.2	0.0	0.0	0.0	-0.3	-0.1	-0.4	-1.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-6-2. Sacramento River at Balls Ferry, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	56	52	49	49	51	53	55	55	56	57	61
20%	57	56	51	49	48	50	52	54	54	55	57	58
30%	56	55	51	48	48	50	52	53	54	55	56	57
40%	56	55	50	48	48	50	51	53	53	54	55	56
50%	55	55	50	47	47	49	51	53	53	54	55	55
60%	55	54	50	47	47	48	51	52	53	53	55	54
70%	55	54	49	47	46	48	50	52	52	53	54	53
80%	55	54	49	46	46	47	50	52	52	53	54	53
90%	54	53	48	46	45	47	49	51	52	52	53	52
Long Term												
Full Simulation Period ^b	56	55	50	47	47	49	51	53	53	54	56	56
Water Year Types ^c												
Wet (32%)	53	52	48	47	46	47	50	53	53	53	54	53
Above Normal (16%)	56	54	50	47	46	48	51	53	52	52	54	54
Below Normal (13%)	56	55	51	47	47	50	51	52	53	53	55	56
Dry (24%)	56	55	50	48	48	50	52	53	53	54	56	57
Critical (15%)	59	56	51	48	48	50	51	54	55	57	60	63

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	59	56	52	49	49	51	53	55	55	56	57	59
20%	57	55	51	48	48	50	52	54	54	55	56	58
30%	56	55	51	48	48	50	52	53	53	54	56	57
40%	56	55	50	48	48	50	51	53	53	54	55	57
50%	56	54	50	47	47	49	51	53	53	54	55	56
60%	55	54	50	47	47	48	51	52	53	53	55	56
70%	55	53	49	47	46	48	50	52	52	53	54	55
80%	54	53	49	46	46	47	50	52	52	52	54	54
90%	54	53	49	46	45	47	49	51	52	52	53	54
Long Term												
Full Simulation Period ^b	56	54	50	47	47	49	51	53	53	54	56	57
Water Year Types ^c												
Wet (32%)	53	52	48	47	46	48	50	53	53	53	54	55
Above Normal (16%)	56	54	50	47	46	48	51	52	52	53	54	55
Below Normal (13%)	55	54	50	47	47	50	51	52	53	53	55	56
Dry (24%)	56	54	50	48	48	50	52	53	53	54	56	57
Critical (15%)	58	56	51	48	48	50	52	54	55	57	59	62

Alternative 3 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-1.4	-0.3	0.1	-0.1	0.2	-0.2	0.2	0.1	-0.3	-0.3	-0.2	-1.4
0.2	-0.1	-0.1	-0.3	-0.1	0.1	0.0	-0.1	-0.2	0.0	-0.2	-0.5	-0.4
0.3	0.0	-0.3	-0.1	0.0	0.0	0.0	0.1	0.0	-0.3	-0.2	-0.1	-0.2
0.4	-0.1	-0.5	-0.2	0.1	0.0	0.0	-0.1	-0.1	-0.1	0.0	0.1	0.5
0.5	0.0	-0.5	-0.2	-0.1	0.0	-0.1	0.0	-0.1	-0.2	0.0	-0.1	0.4
0.6	0.1	-0.6	0.0	0.1	0.0	0.0	0.0	-0.1	-0.2	0.2	0.0	1.6
0.7	-0.1	-0.5	0.1	0.0	0.0	0.1	0.0	-0.2	-0.2	0.1	-0.1	1.3
0.8	-0.3	-0.6	0.1	0.1	0.2	0.0	-0.3	0.0	-0.2	-0.1	-0.1	1.6
0.9	-0.2	-0.2	0.2	0.0	0.0	0.1	0.0	0.0	-0.1	0.1	-0.1	1.1
Long Term												
Full Simulation Period ^b	-0.2	-0.4	-0.1	0.0	0.0	0.0	0.0	0.0	-0.2	0.0	-0.2	0.5
Water Year Types ^c												
Wet (32%)	-0.1	-0.3	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	-0.1	1.8
Above Normal (16%)	0.0	-0.4	-0.2	0.0	0.0	-0.1	0.0	-0.2	-0.1	0.2	0.1	1.5
Below Normal (13%)	-0.3	-0.6	-0.4	0.0	0.0	-0.2	0.0	0.0	-0.1	-0.1	-0.1	-0.7
Dry (24%)	-0.1	-0.4	-0.1	-0.1	0.0	0.0	-0.1	-0.1	-0.3	-0.1	-0.2	-0.2
Critical (15%)	-0.5	-0.2	0.0	0.2	0.1	0.0	0.1	0.0	-0.3	0.0	-0.5	-1.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-6-3. Sacramento River at Balls Ferry, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	56	52	49	49	51	53	55	55	56	57	61
20%	57	56	51	49	48	50	52	54	54	55	57	58
30%	56	55	51	48	48	50	52	53	54	55	56	57
40%	56	55	50	48	48	50	51	53	53	54	55	56
50%	55	55	50	47	47	49	51	53	53	54	55	55
60%	55	54	50	47	47	48	51	52	53	53	55	54
70%	55	54	49	47	46	48	50	52	52	53	54	53
80%	55	54	49	46	46	47	50	52	52	53	54	53
90%	54	53	48	46	45	47	49	51	52	52	53	52
Long Term												
Full Simulation Period ^b	56	55	50	47	47	49	51	53	53	54	56	56
Water Year Types ^c												
Wet (32%)	53	52	48	47	46	47	50	53	53	53	54	53
Above Normal (16%)	56	54	50	47	46	48	51	53	52	52	54	54
Below Normal (13%)	56	55	51	47	47	50	51	52	53	53	55	56
Dry (24%)	56	55	50	48	48	50	52	53	53	54	56	57
Critical (15%)	59	56	51	48	48	50	51	54	55	57	60	63

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	56	52	49	49	51	53	55	56	56	58	61
20%	57	56	51	49	48	50	52	54	54	55	57	58
30%	56	55	51	48	48	50	52	54	54	55	56	57
40%	56	55	50	47	48	50	51	53	53	54	55	56
50%	56	55	50	47	47	49	51	53	53	54	55	55
60%	55	54	50	47	47	48	51	52	53	53	55	54
70%	55	54	49	47	46	48	50	52	52	53	54	53
80%	55	54	49	46	46	47	50	52	52	53	54	53
90%	54	53	48	46	45	47	49	51	52	52	54	52
Long Term												
Full Simulation Period ^b	56	55	50	47	47	49	51	53	53	54	56	56
Water Year Types ^c												
Wet (32%)	53	52	48	47	46	47	50	53	53	53	54	53
Above Normal (16%)	56	54	50	47	46	48	51	53	52	52	54	54
Below Normal (13%)	55	54	51	47	48	50	51	53	53	53	55	56
Dry (24%)	56	55	50	48	48	50	52	53	53	54	56	57
Critical (15%)	59	56	51	48	48	50	52	54	56	57	60	63

Alternative 5 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.1	0.7
0.2	-0.2	-0.1	0.1	0.0	0.0	0.0	0.1	0.0	0.0	0.0	-0.1	0.0
0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	-0.1	-0.1	0.0	-0.1
0.4	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1
0.5	0.0	-0.1	0.0	-0.1	0.0	0.0	0.1	0.1	0.0	0.0	0.0	-0.1
0.6	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.2
0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0
0.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
0.9	0.0	0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.1	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-0.1	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.1	0.0
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.0	-0.1	-0.2	-0.1
Critical (15%)	0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	-0.2	-0.2	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-6-4. Sacramento River at Balls Ferry, Monthly Temperature

Second Basis of Comparison		Monthly Temperature (DEG-F)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	59	56	52	49	49	51	53	55	55	56	58	59	
20%	57	56	51	48	48	50	52	54	54	55	56	58	
30%	56	55	51	48	48	50	52	53	53	54	56	57	
40%	56	55	50	48	48	49	51	53	53	54	55	57	
50%	56	54	50	47	47	49	51	53	53	54	55	56	
60%	55	54	50	47	47	48	51	52	53	53	55	56	
70%	55	53	49	47	46	48	50	52	52	53	54	55	
80%	55	53	49	46	46	47	50	52	52	52	54	55	
90%	54	53	48	46	45	47	49	51	51	52	53	54	
Long Term													
Full Simulation Period ^b	56	54	50	47	47	49	51	53	53	54	55	57	
Water Year Types^c													
Wet (32%)	53	52	48	47	46	48	50	53	53	53	54	55	
Above Normal (16%)	56	54	50	47	46	48	51	52	52	53	54	55	
Below Normal (13%)	55	54	50	47	47	49	51	52	53	53	54	56	
Dry (24%)	56	54	50	48	48	50	52	53	53	54	56	57	
Critical (15%)	58	56	51	48	48	50	51	54	55	57	60	62	

No Action Alternative		Monthly Temperature (DEG-F)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	61	56	52	49	49	51	53	55	55	56	57	61	
20%	57	56	51	49	48	50	52	54	54	55	57	58	
30%	56	55	51	48	48	50	52	53	54	55	56	57	
40%	56	55	50	48	48	50	51	53	53	54	55	56	
50%	55	55	50	47	47	49	51	53	53	54	55	55	
60%	55	54	50	47	47	48	51	52	53	53	55	54	
70%	55	54	49	47	46	48	50	52	52	53	54	53	
80%	55	54	49	46	46	47	50	52	52	53	54	53	
90%	54	53	48	46	45	47	49	51	52	52	53	52	
Long Term													
Full Simulation Period ^b	56	55	50	47	47	49	51	53	53	54	56	56	
Water Year Types^c													
Wet (32%)	53	52	48	47	46	47	50	53	53	53	54	53	
Above Normal (16%)	56	54	50	47	46	48	51	53	52	52	54	54	
Below Normal (13%)	56	55	51	47	47	50	51	52	53	53	55	56	
Dry (24%)	56	55	50	48	48	50	52	53	53	54	56	57	
Critical (15%)	59	56	51	48	48	50	51	54	55	57	60	63	

No Action Alternative minus Second Basis of Comparison		Monthly Temperature (DEG-F)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
0.1	1.5	0.3	0.0	-0.1	-0.2	0.3	-0.2	-0.1	0.4	0.4	-0.5	1.3	
0.2	0.0	0.1	0.3	0.1	-0.1	0.0	0.1	0.1	0.0	0.2	0.3	0.3	
0.3	0.0	0.4	0.2	0.0	0.0	-0.1	-0.1	0.1	0.3	0.2	0.2	0.2	
0.4	0.0	0.5	0.2	-0.1	0.0	0.1	0.2	0.1	0.2	0.0	0.1	-0.6	
0.5	-0.1	0.5	0.2	0.1	0.0	0.1	0.1	0.1	0.3	0.0	0.2	-0.6	
0.6	0.0	0.5	0.0	0.0	0.0	0.0	0.0	0.1	0.2	-0.2	0.0	-1.7	
0.7	0.0	0.5	-0.1	0.0	0.0	-0.2	0.1	0.2	0.1	-0.2	0.1	-1.7	
0.8	0.3	0.5	-0.2	0.0	-0.1	0.0	0.3	0.2	0.2	0.1	0.1	-1.8	
0.9	0.0	0.1	-0.1	0.0	0.0	-0.1	0.1	0.0	0.2	-0.1	0.1	-1.3	
Long Term													
Full Simulation Period ^b	0.1	0.4	0.1	0.0	0.0	0.0	0.0	0.1	0.2	0.0	0.2	-0.7	
Water Year Types^c													
Wet (32%)	0.1	0.3	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.2	-2.0	
Above Normal (16%)	0.0	0.4	0.1	-0.1	0.0	0.1	0.0	0.2	0.2	-0.1	0.1	-1.5	
Below Normal (13%)	0.3	0.6	0.4	0.0	0.0	0.2	0.0	0.0	0.2	0.0	0.3	0.0	
Dry (24%)	0.0	0.3	0.2	0.1	0.0	0.0	0.1	0.1	0.3	0.1	-0.1	0.1	
Critical (15%)	0.6	0.3	0.0	-0.2	-0.2	0.0	0.0	0.0	0.3	0.1	0.4	1.0	

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-6-5. Sacramento River at Balls Ferry, Monthly Temperature

Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	59	56	52	49	49	51	53	55	55	56	58	59
20%	57	56	51	48	48	50	52	54	54	55	56	58
30%	56	55	51	48	48	50	52	53	53	54	56	57
40%	56	55	50	48	48	49	51	53	53	54	55	57
50%	56	54	50	47	47	49	51	53	53	54	55	56
60%	55	54	50	47	47	48	51	52	53	53	55	56
70%	55	53	49	47	46	48	50	52	52	53	54	55
80%	55	53	49	46	46	47	50	52	52	52	54	55
90%	54	53	48	46	45	47	49	51	51	52	53	54
Long Term												
Full Simulation Period ^b	56	54	50	47	47	49	51	53	53	54	55	57
Water Year Types^c												
Wet (32%)	53	52	48	47	46	48	50	53	53	53	54	55
Above Normal (16%)	56	54	50	47	46	48	51	52	52	53	54	55
Below Normal (13%)	55	54	50	47	47	49	51	52	53	53	54	56
Dry (24%)	56	54	50	48	48	50	52	53	53	54	56	57
Critical (15%)	58	56	51	48	48	50	51	54	55	57	60	62

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	59	56	52	49	49	51	53	55	55	56	57	59
20%	57	55	51	48	48	50	52	54	54	55	56	58
30%	56	55	51	48	48	50	52	53	53	54	56	57
40%	56	55	50	48	48	50	51	53	53	54	55	57
50%	56	54	50	47	47	49	51	53	53	54	55	56
60%	55	54	50	47	47	48	51	52	53	53	55	56
70%	55	53	49	47	46	48	50	52	52	53	54	55
80%	54	53	49	46	46	47	50	52	52	52	54	54
90%	54	53	49	46	45	47	49	51	52	52	53	54
Long Term												
Full Simulation Period ^b	56	54	50	47	47	49	51	53	53	54	56	57
Water Year Types^c												
Wet (32%)	53	52	48	47	46	48	50	53	53	53	54	55
Above Normal (16%)	56	54	50	47	46	48	51	52	52	53	54	55
Below Normal (13%)	55	54	50	47	47	50	51	52	53	53	55	56
Dry (24%)	56	54	50	48	48	50	52	53	53	54	56	57
Critical (15%)	58	56	51	48	48	50	52	54	55	57	59	62

Alternative 3 minus Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
0.1	0.1	0.0	0.1	-0.3	0.0	0.1	0.0	-0.1	0.1	0.1	-0.6	-0.1
0.2	-0.2	-0.1	0.0	0.0	-0.1	0.0	0.1	-0.1	0.0	-0.1	-0.2	-0.1
0.3	0.0	0.1	0.2	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.1	-0.1
0.4	-0.1	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.1	0.0	0.1	-0.1
0.5	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.1	-0.2
0.6	0.1	-0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1
0.7	-0.1	0.0	-0.1	0.0	0.0	-0.1	0.0	0.0	0.0	-0.1	0.0	-0.4
0.8	0.0	-0.1	-0.1	0.0	0.0	0.0	0.0	0.2	0.0	0.0	0.1	-0.2
0.9	-0.1	0.0	0.1	0.0	0.0	0.0	0.1	0.0	0.1	0.0	0.0	-0.2
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.2
Water Year Types^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.2
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.1	-0.1	0.2	-0.6
Dry (24%)	-0.2	-0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	-0.2	-0.1
Critical (15%)	0.1	0.1	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.1	-0.1	-0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-6-6. Sacramento River at Balls Ferry, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	59	56	52	49	49	51	53	55	55	56	58	59
20%	57	56	51	48	48	50	52	54	54	55	56	58
30%	56	55	51	48	48	50	52	53	53	54	56	57
40%	56	55	50	48	48	49	51	53	53	54	55	57
50%	56	54	50	47	47	49	51	53	53	54	55	56
60%	55	54	50	47	47	48	51	52	53	53	55	56
70%	55	53	49	47	46	48	50	52	52	53	54	55
80%	55	53	49	46	46	47	50	52	52	52	54	55
90%	54	53	48	46	45	47	49	51	51	52	53	54
Long Term												
Full Simulation Period ^b	56	54	50	47	47	49	51	53	53	54	55	57
Water Year Types ^c												
Wet (32%)	53	52	48	47	46	48	50	53	53	53	54	55
Above Normal (16%)	56	54	50	47	46	48	51	52	52	53	54	55
Below Normal (13%)	55	54	50	47	47	49	51	52	53	53	54	56
Dry (24%)	56	54	50	48	48	50	52	53	53	54	56	57
Critical (15%)	58	56	51	48	48	50	51	54	55	57	60	62

Alternative 5

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	56	52	49	49	51	53	55	56	56	58	61
20%	57	56	51	49	48	50	52	54	54	55	57	58
30%	56	55	51	48	48	50	52	54	54	55	56	57
40%	56	55	50	47	48	50	51	53	53	54	55	56
50%	56	55	50	47	47	49	51	53	53	54	55	55
60%	55	54	50	47	47	48	51	52	53	53	55	54
70%	55	54	49	47	46	48	50	52	52	53	54	53
80%	55	54	49	46	46	47	50	52	52	53	54	53
90%	54	53	48	46	45	47	49	51	52	52	54	52
Long Term												
Full Simulation Period ^b	56	55	50	47	47	49	51	53	53	54	56	56
Water Year Types ^c												
Wet (32%)	53	52	48	47	46	47	50	53	53	53	54	53
Above Normal (16%)	56	54	50	47	46	48	51	53	52	52	54	54
Below Normal (13%)	55	54	51	47	48	50	51	53	53	53	55	56
Dry (24%)	56	55	50	48	48	50	52	53	53	54	56	57
Critical (15%)	59	56	51	48	48	50	52	54	56	57	60	63

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	1.5	0.3	-0.1	-0.1	-0.2	0.3	-0.2	-0.1	0.5	0.3	-0.4	2.0
0.2	-0.2	0.0	0.4	0.1	-0.1	0.0	0.2	0.0	0.0	0.2	0.2	0.2
0.3	0.0	0.4	0.2	0.0	0.0	0.0	0.0	0.2	0.2	0.1	0.2	0.1
0.4	-0.1	0.5	0.2	-0.1	0.0	0.1	0.2	0.2	0.2	0.0	0.0	-0.7
0.5	0.0	0.4	0.2	-0.1	0.0	0.2	0.2	0.2	0.3	0.0	0.3	-0.7
0.6	0.0	0.6	0.0	0.0	0.0	0.0	0.1	0.1	0.2	-0.3	0.0	-1.5
0.7	0.0	0.5	-0.1	0.0	0.0	-0.2	0.1	0.3	0.1	-0.2	0.1	-1.7
0.8	0.3	0.5	-0.2	0.0	-0.1	0.0	0.3	0.2	0.2	0.1	0.2	-1.8
0.9	0.0	0.3	-0.1	0.0	0.0	0.0	0.1	0.1	0.1	-0.1	0.2	-1.3
Long Term												
Full Simulation Period ^b	0.2	0.4	0.1	0.0	0.0	0.0	0.0	0.1	0.2	0.0	0.1	-0.7
Water Year Types ^c												
Wet (32%)	0.1	0.3	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.2	-2.0
Above Normal (16%)	0.0	0.3	0.2	-0.1	0.0	0.1	0.0	0.2	0.2	-0.1	0.1	-1.5
Below Normal (13%)	0.2	0.5	0.4	0.0	0.0	0.2	0.1	0.1	0.2	0.0	0.5	0.0
Dry (24%)	0.0	0.3	0.2	0.1	0.0	0.0	0.1	0.3	0.3	0.0	-0.3	0.0
Critical (15%)	0.7	0.3	0.0	-0.2	-0.2	0.0	0.0	0.1	0.4	-0.1	0.2	1.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


B.7. Sacramento River at Jellys Ferry Temperature

Figure B-7-1. Sacramento River at Jellys Ferry, October

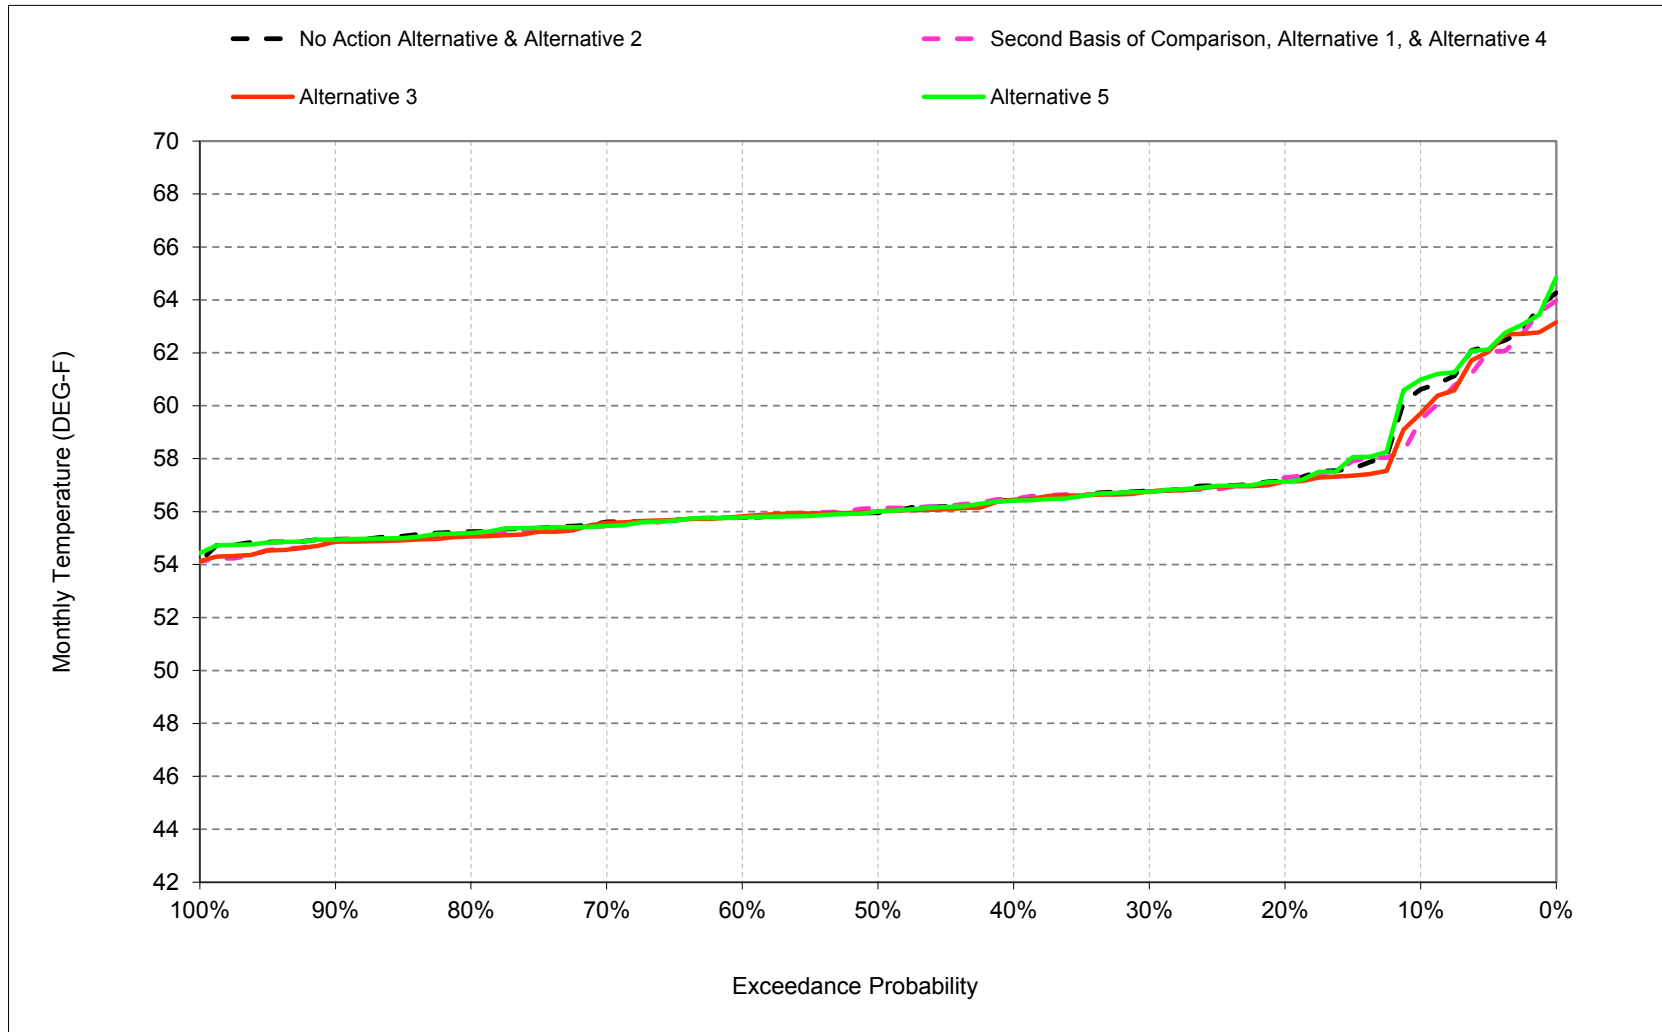


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-7-2. Sacramento River at Jellys Ferry, November

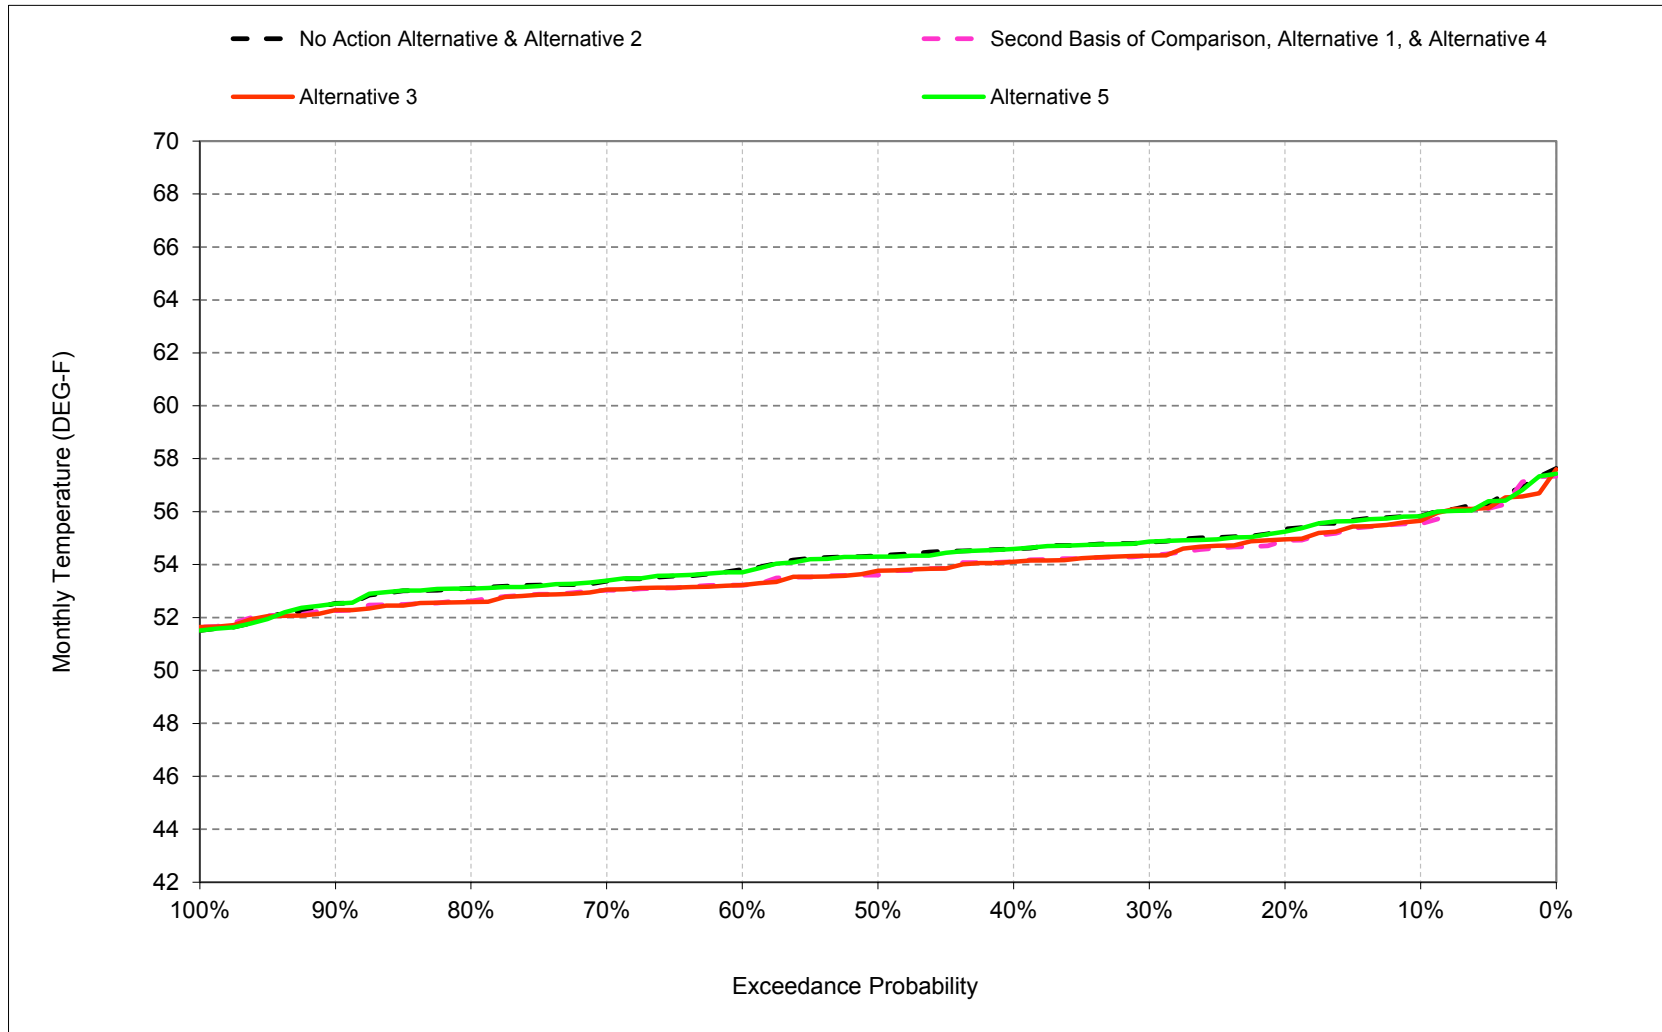


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-7-3. Sacramento River at Jellys Ferry, December

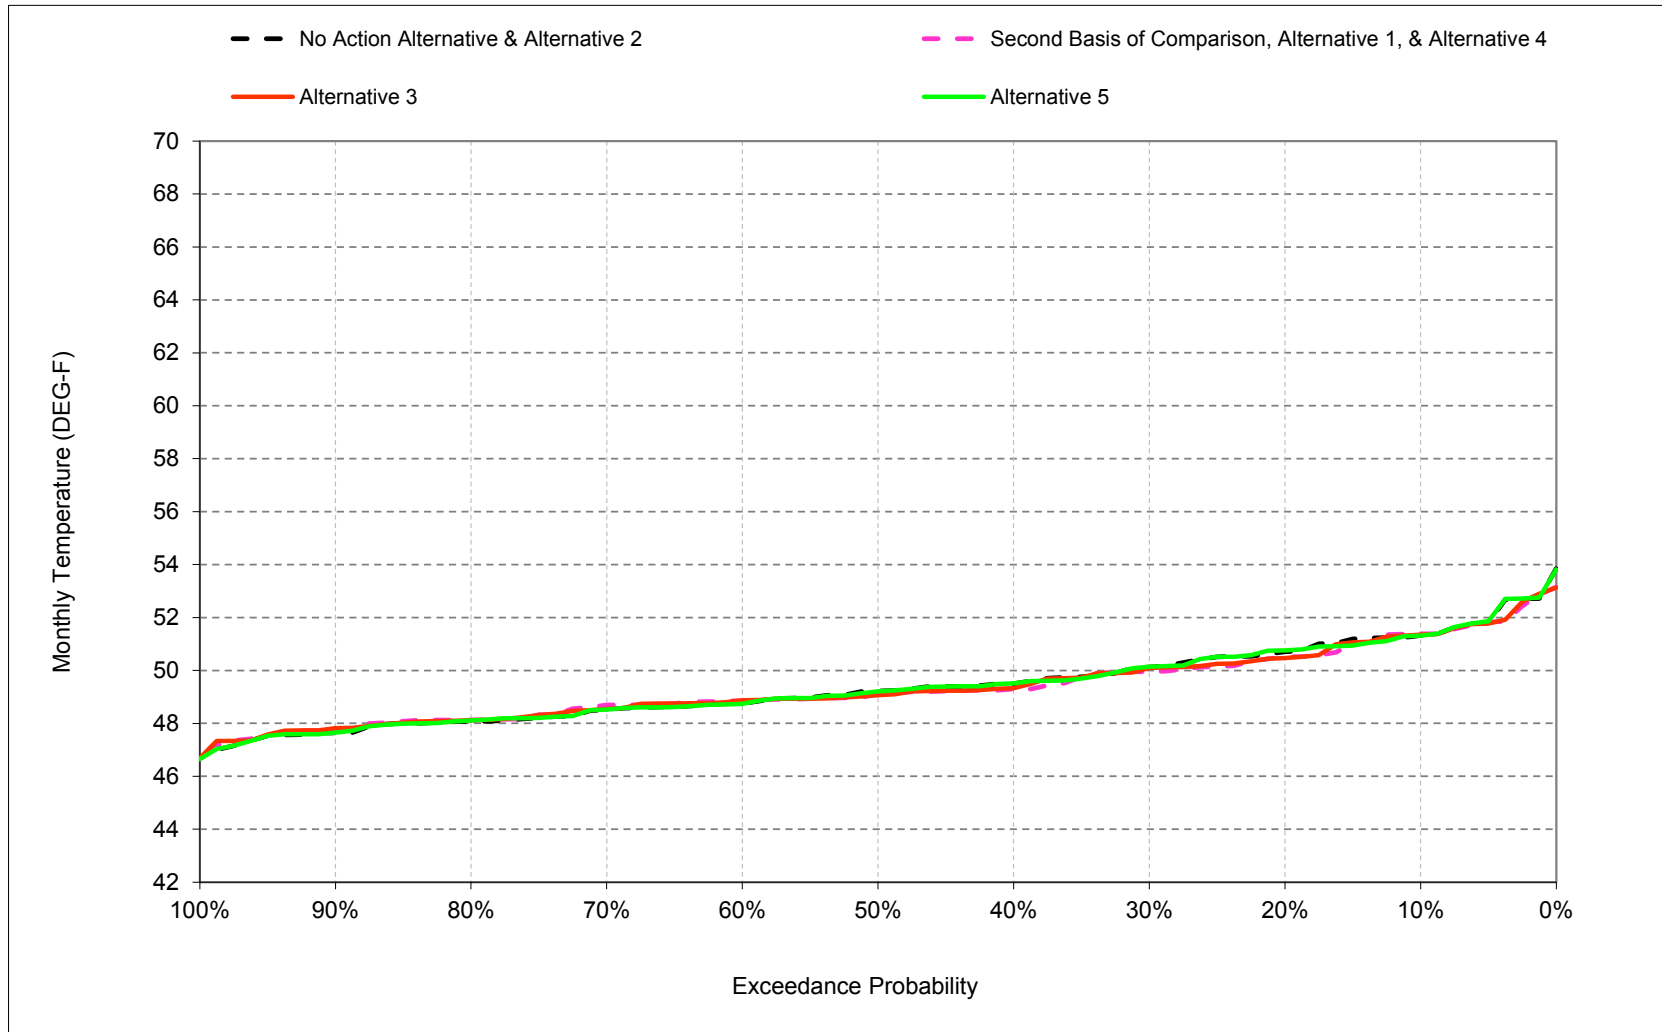


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-7-4. Sacramento River at Jellys Ferry, January

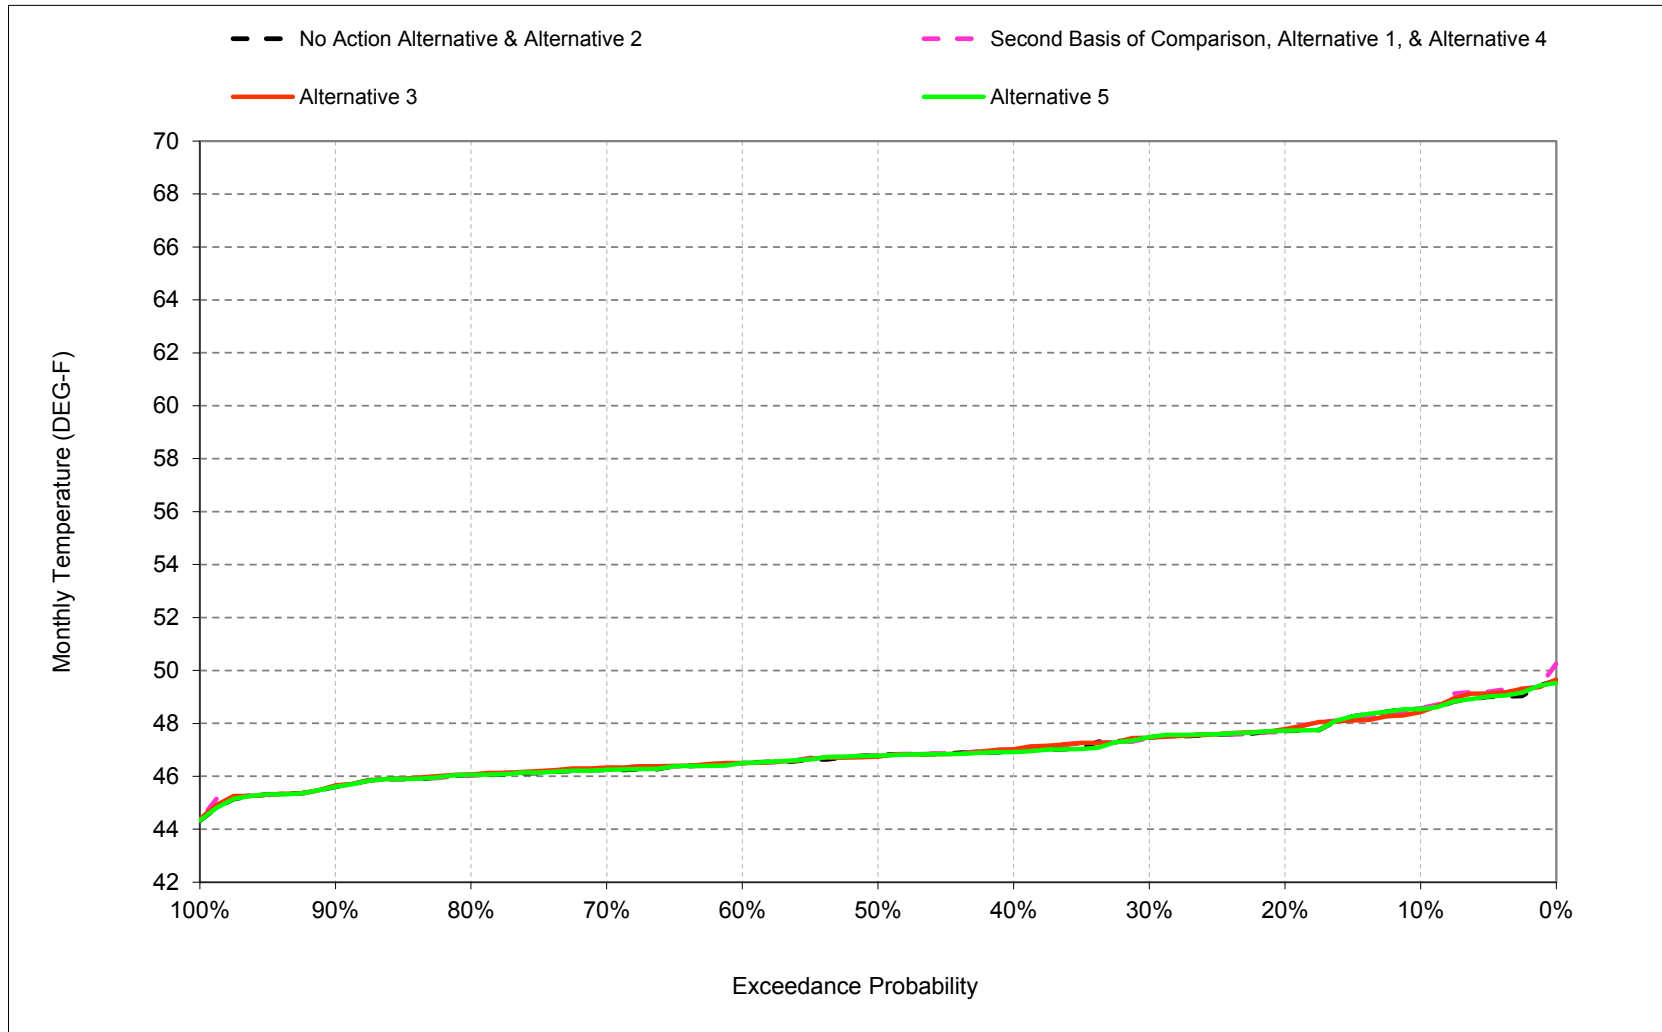


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-7-5. Sacramento River at Jellys Ferry, February

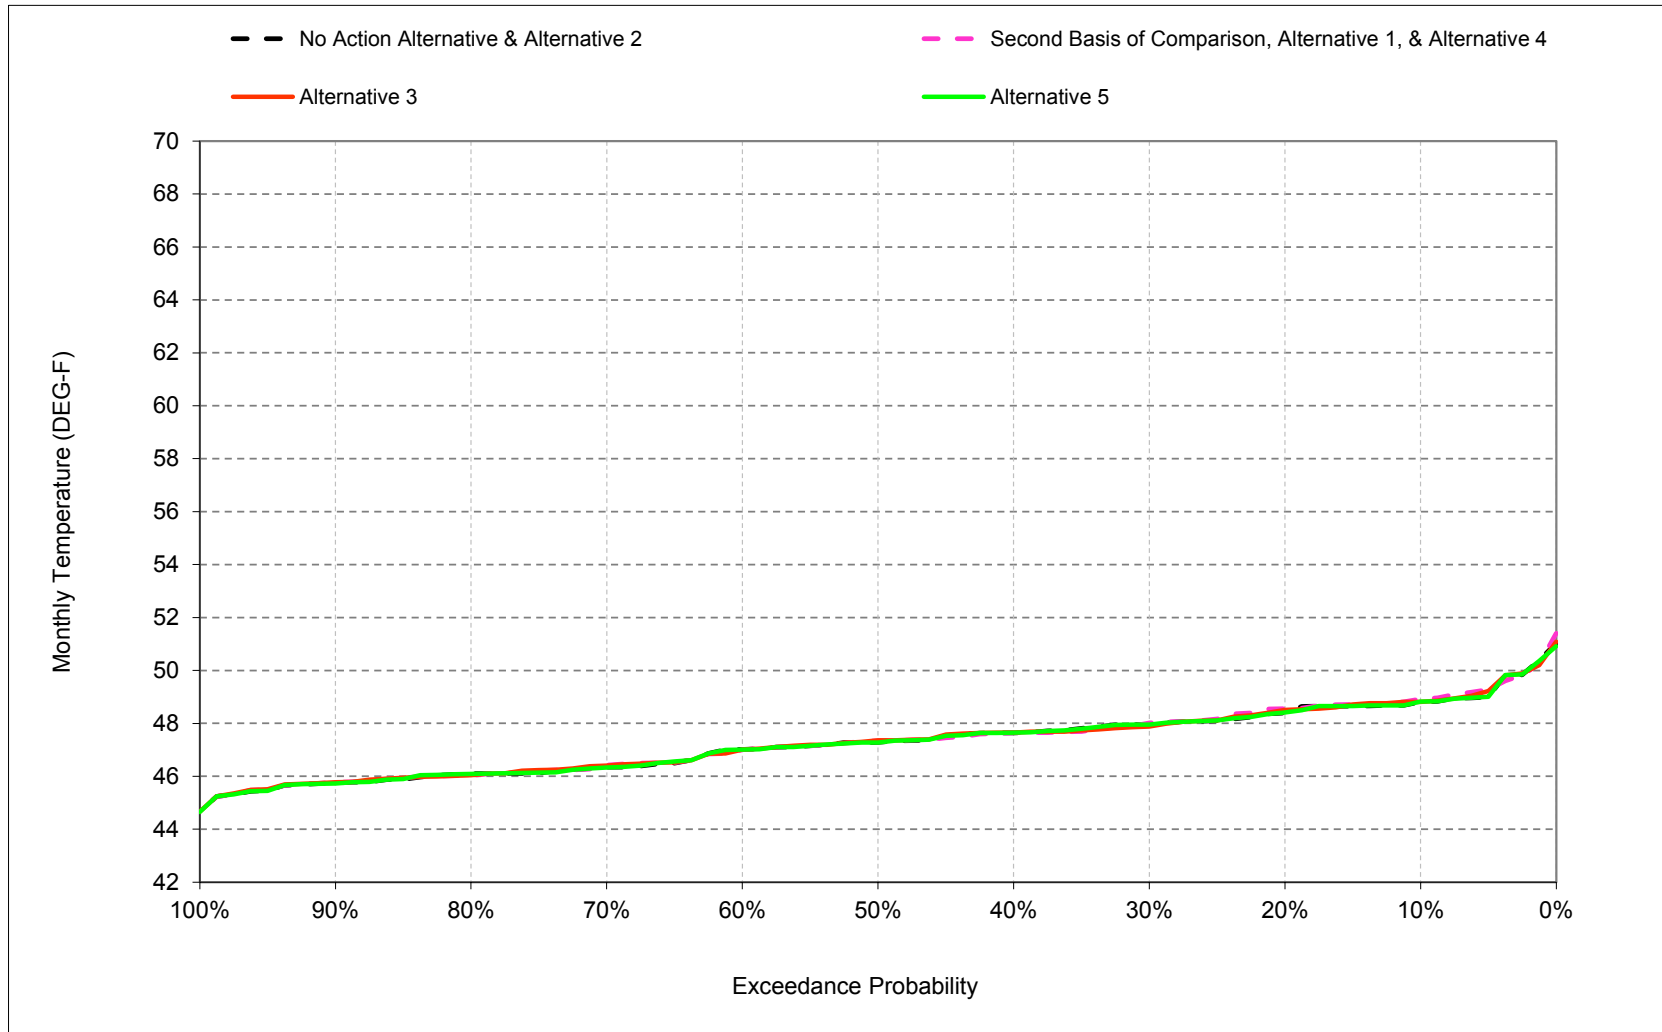


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-7-6. Sacramento River at Jellys Ferry, March

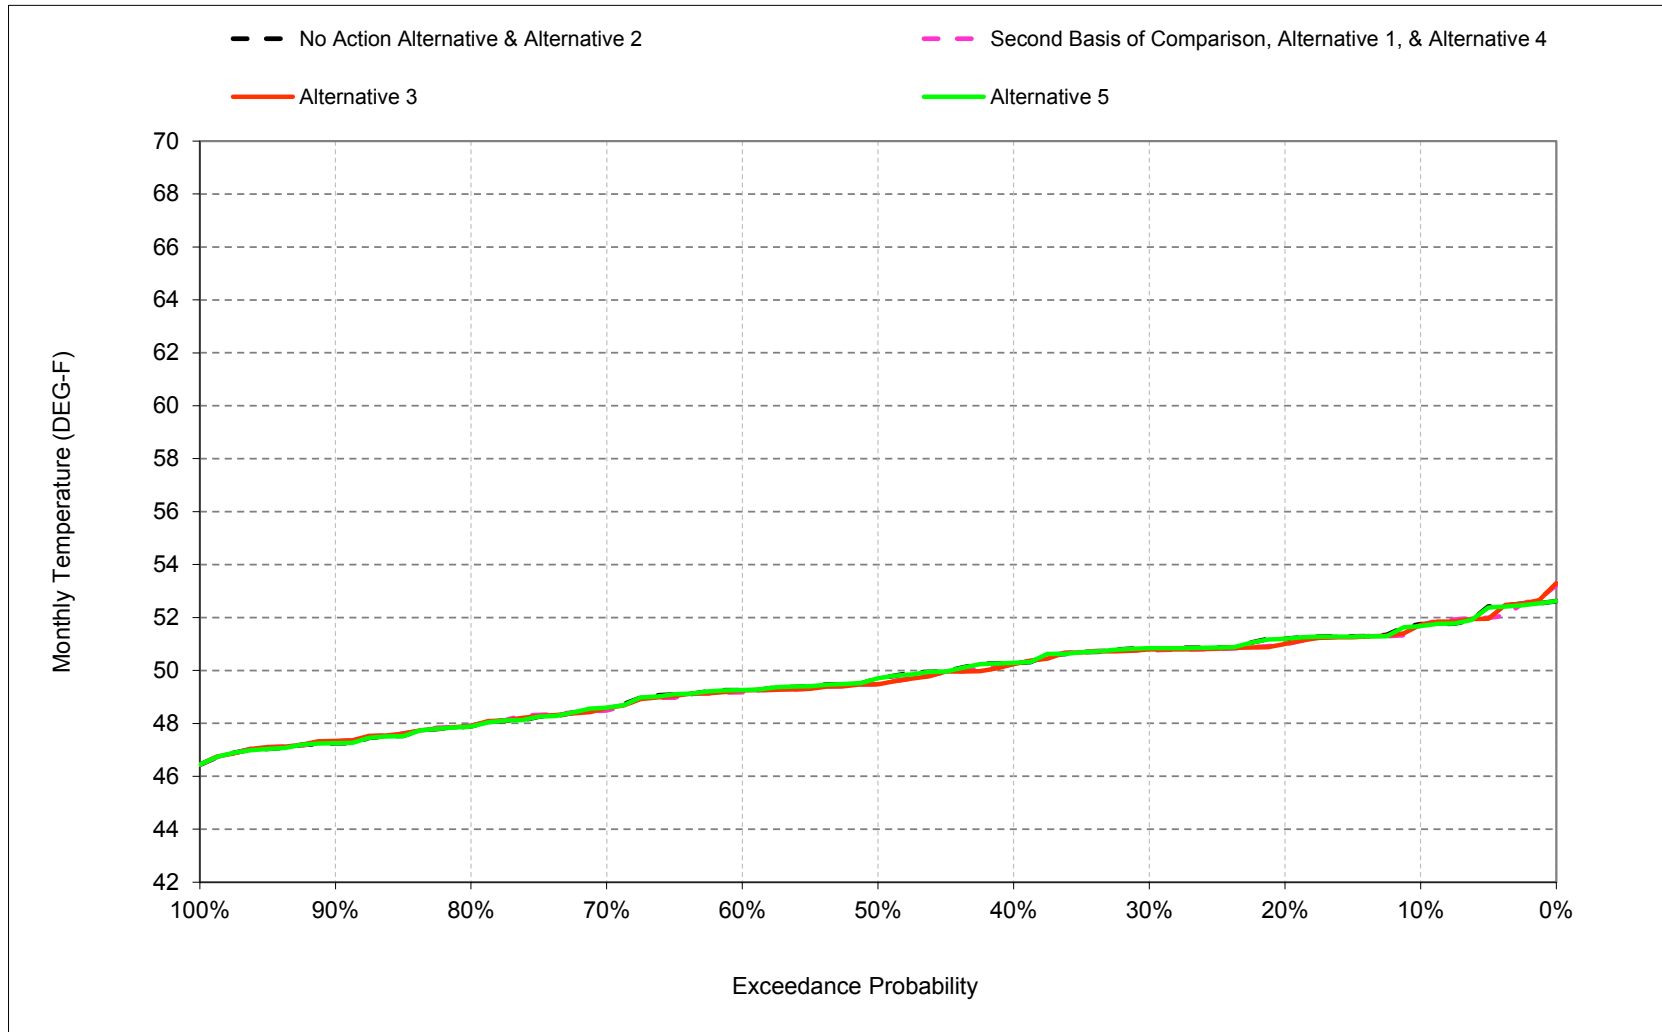


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-7-7. Sacramento River at Jellys Ferry, April

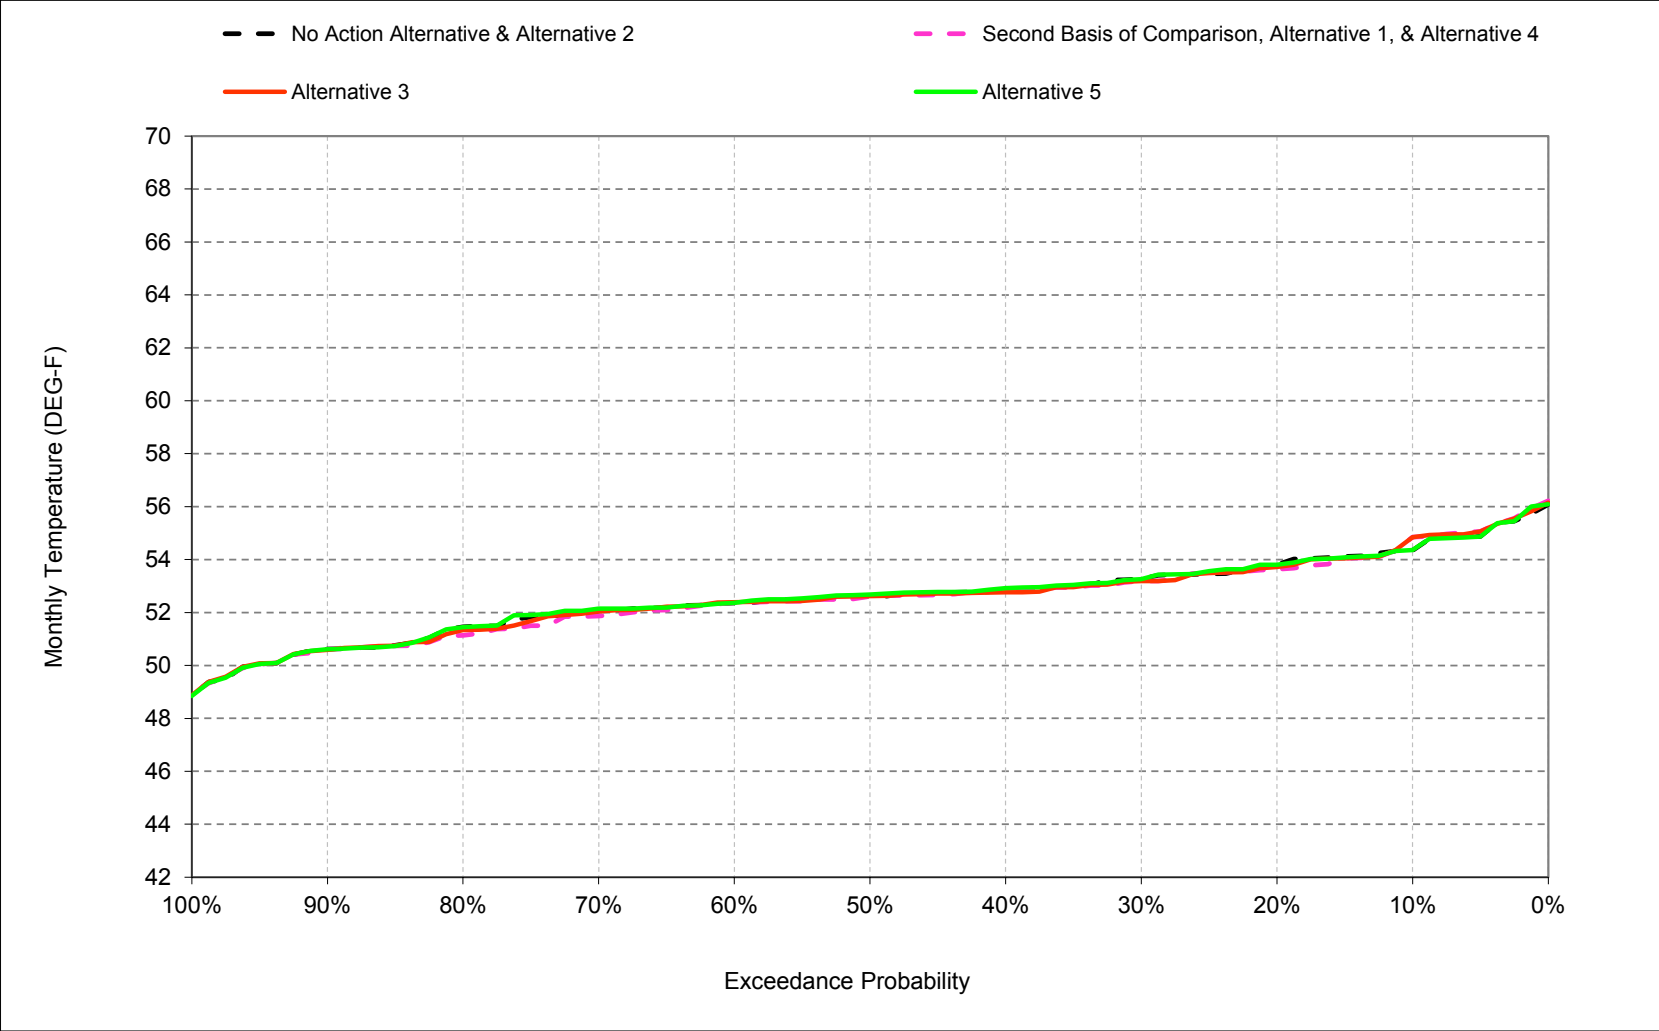


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-7-8. Sacramento River at Jellys Ferry, May

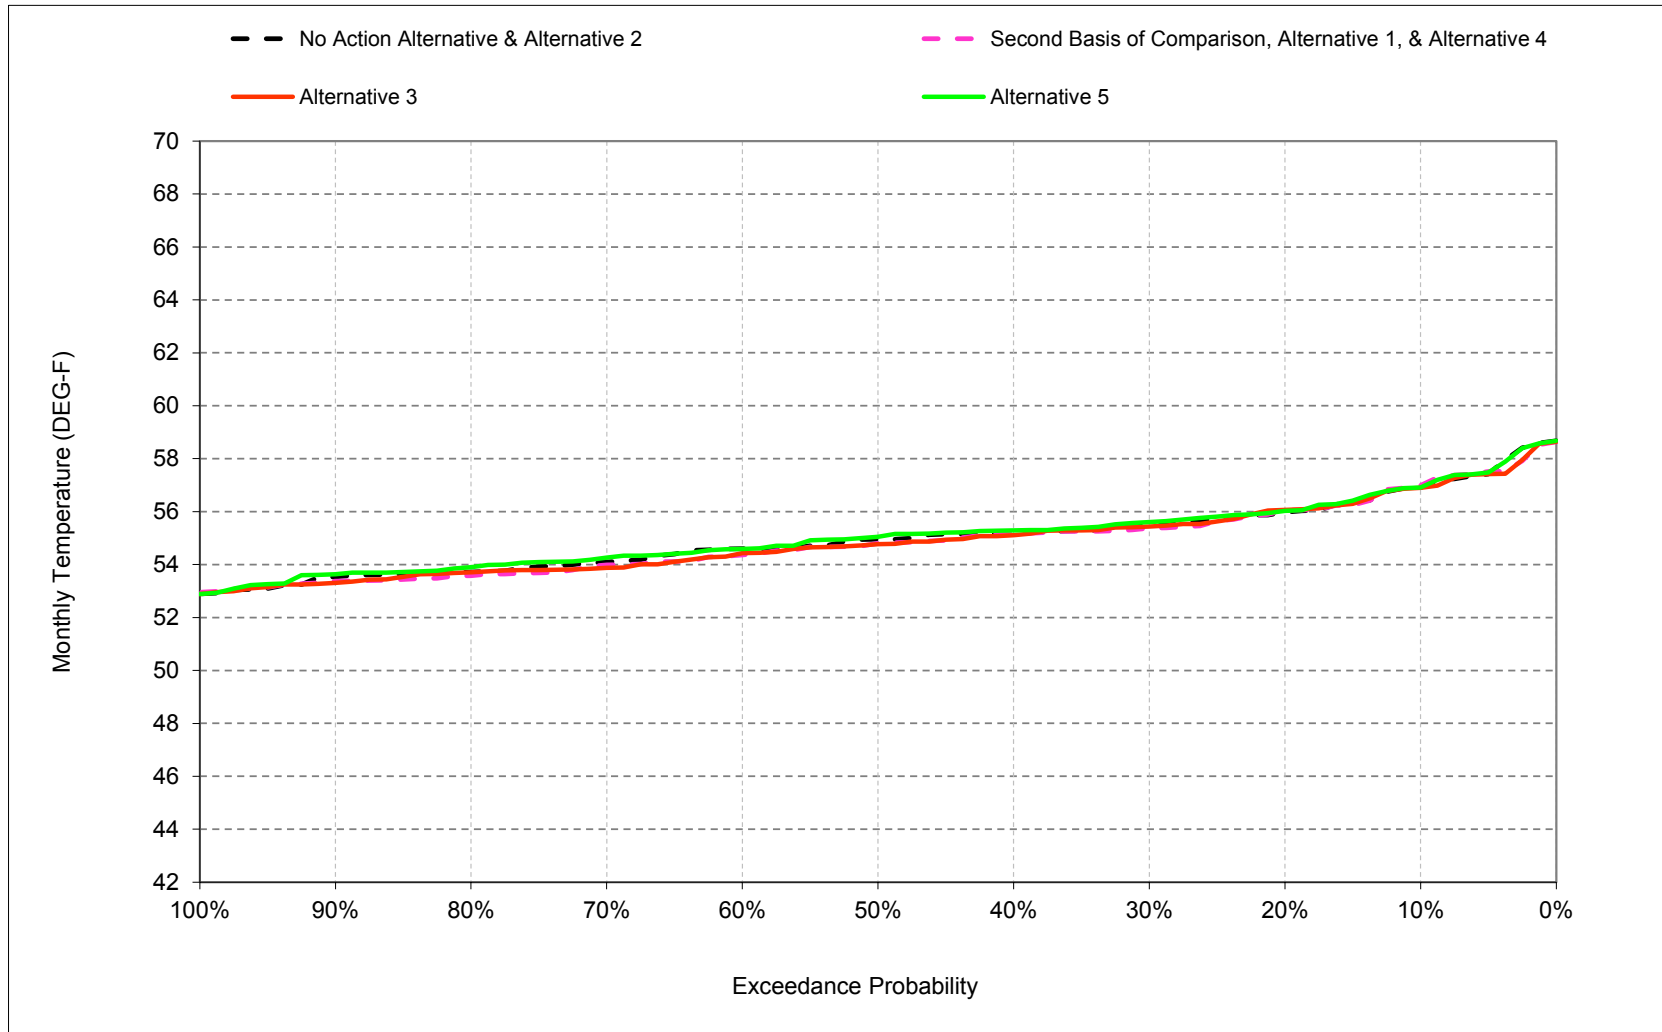


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-7-9. Sacramento River at Jellys Ferry, June

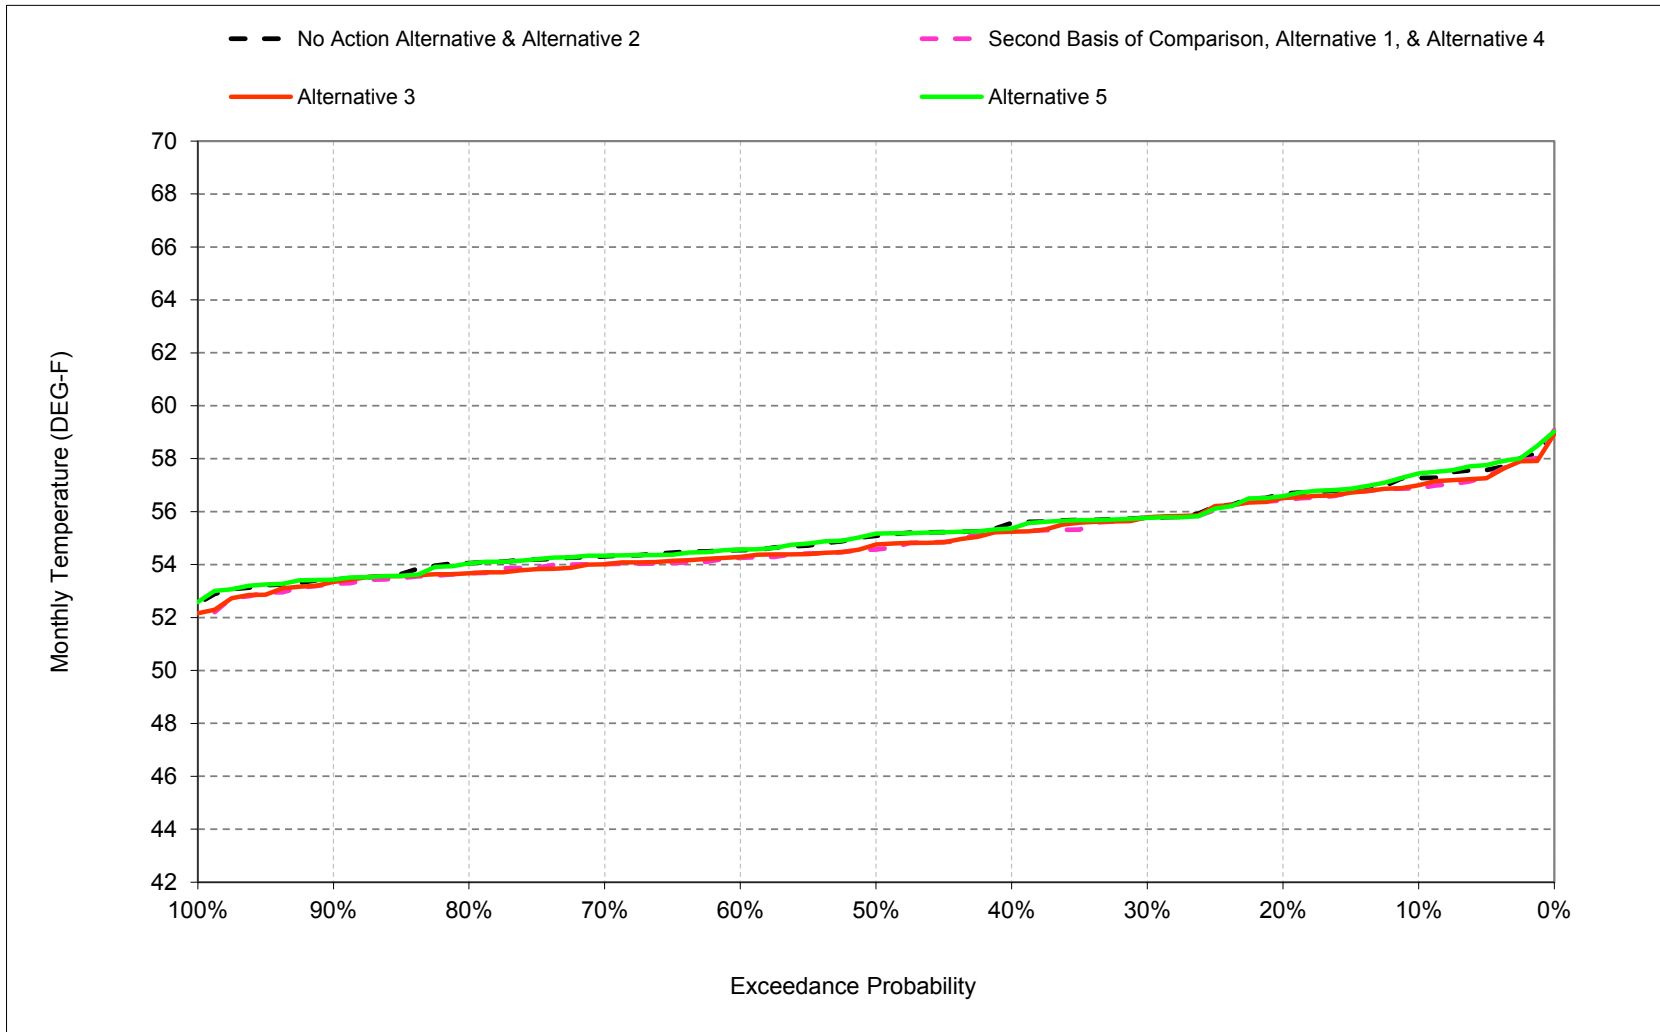


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-7-10. Sacramento River at Jellys Ferry, July

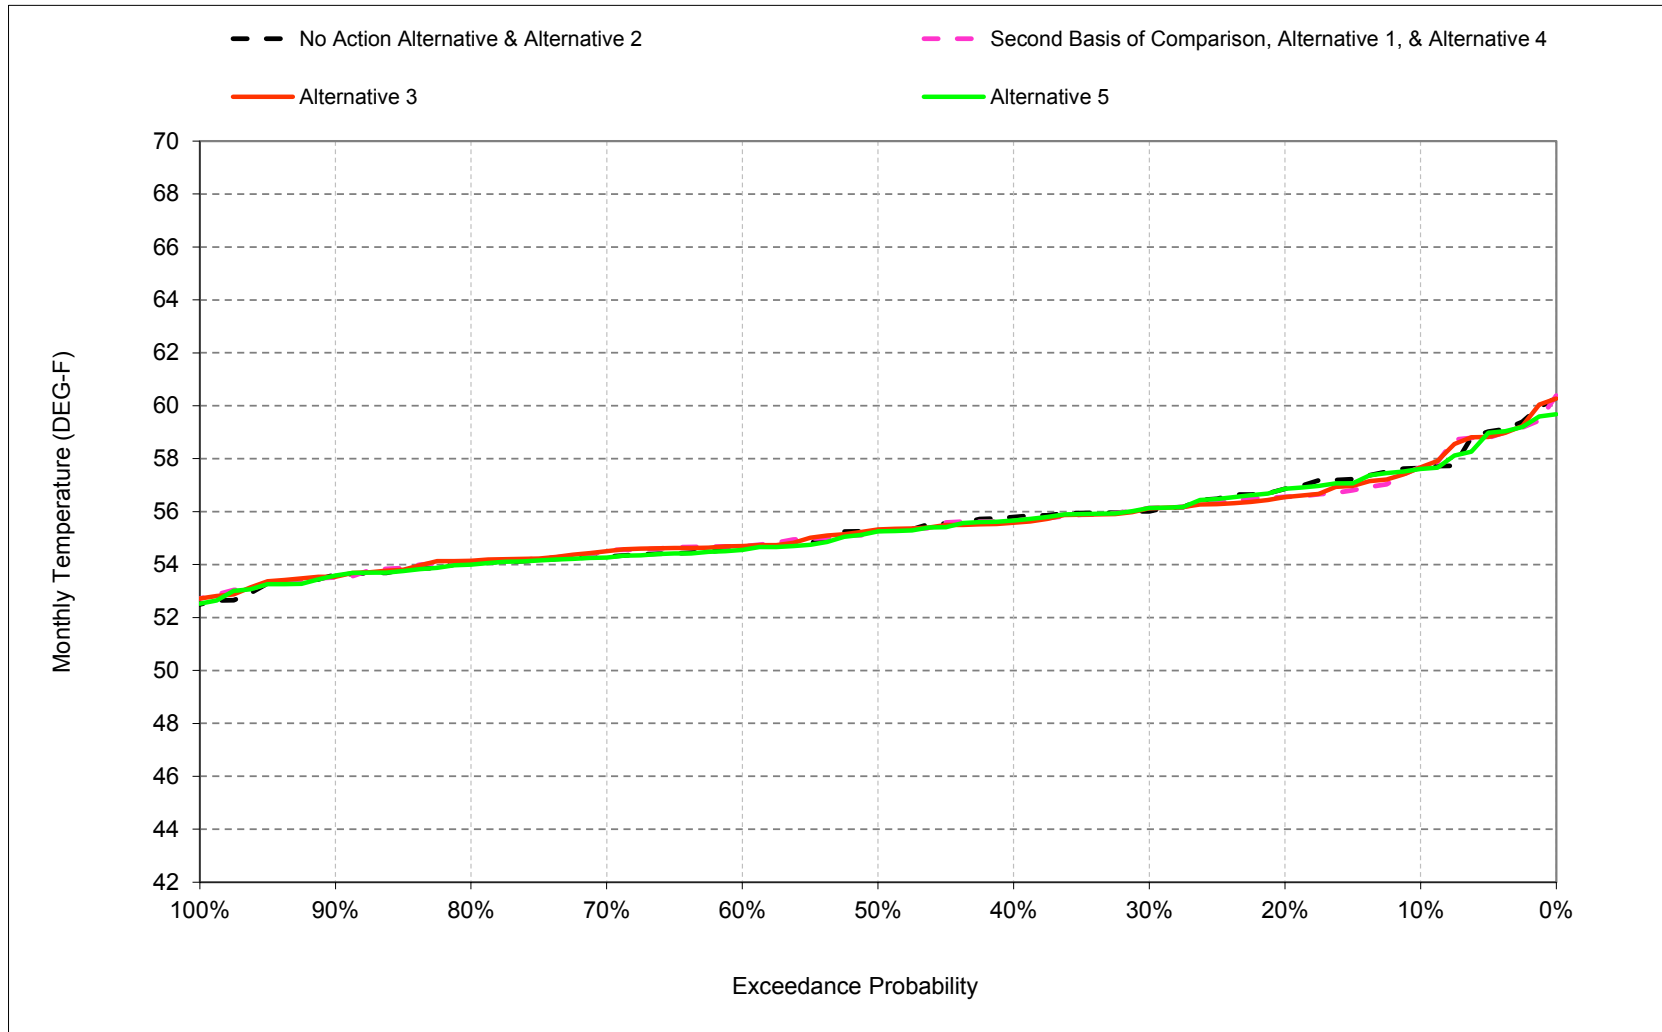


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-7-11. Sacramento River at Jellys Ferry, August

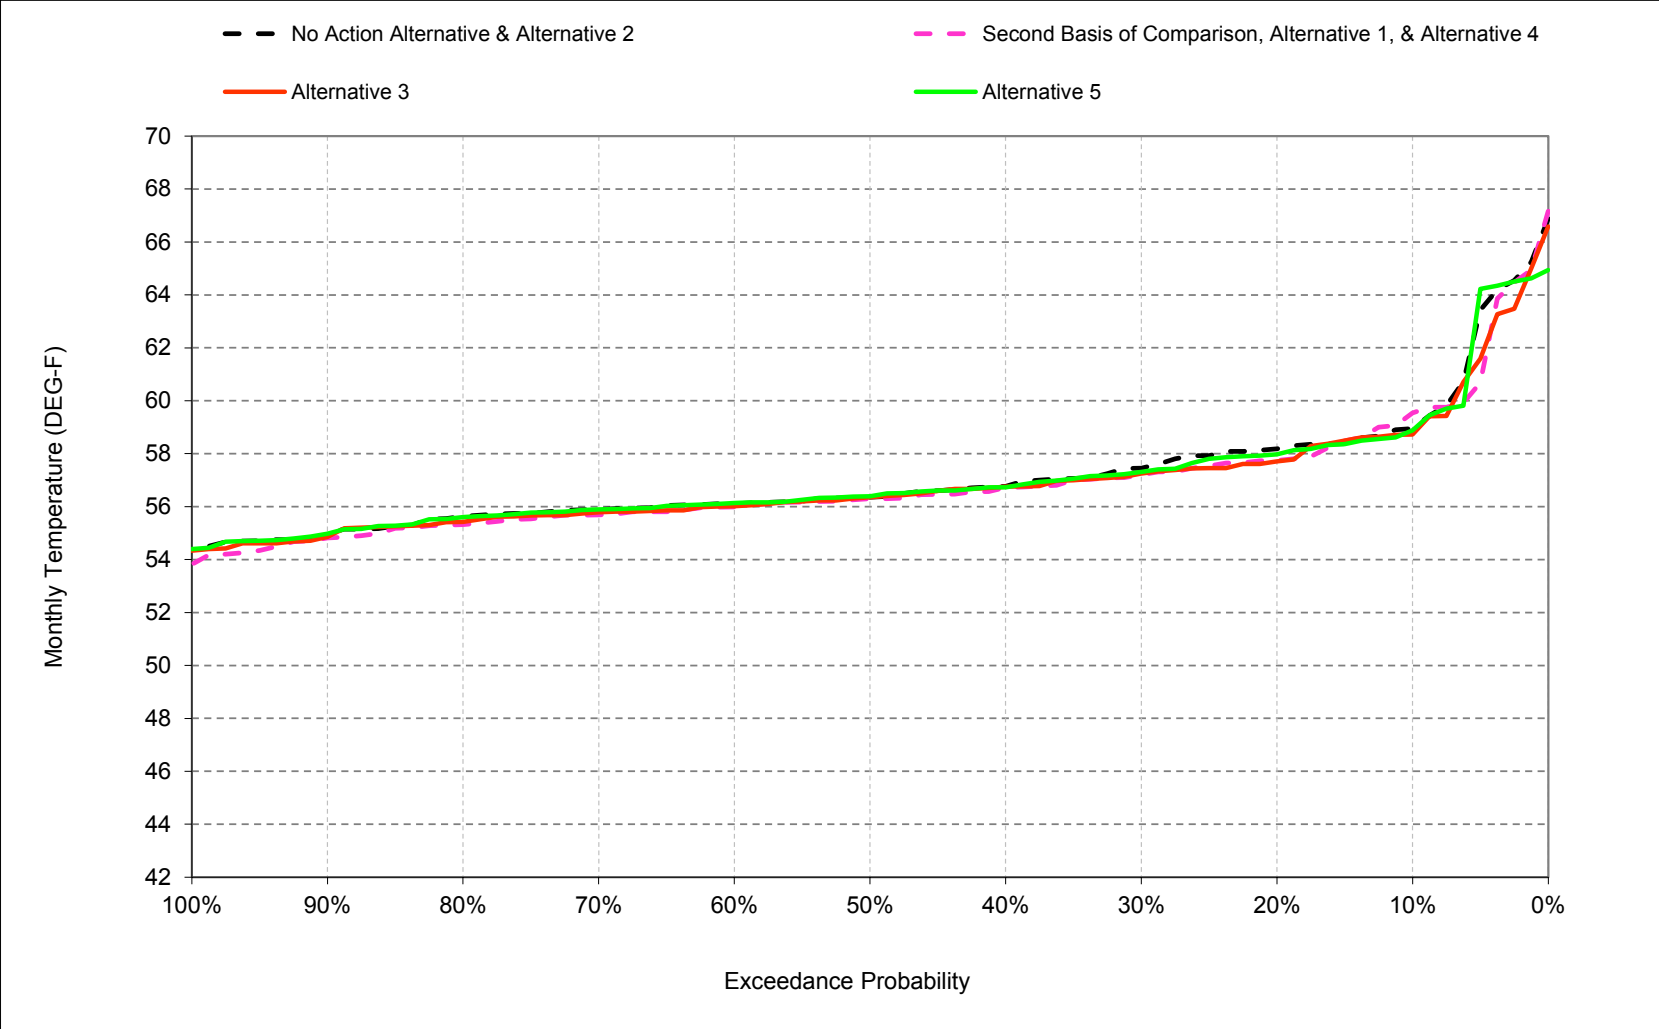

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-7-12. Sacramento River at Jellys Ferry, September

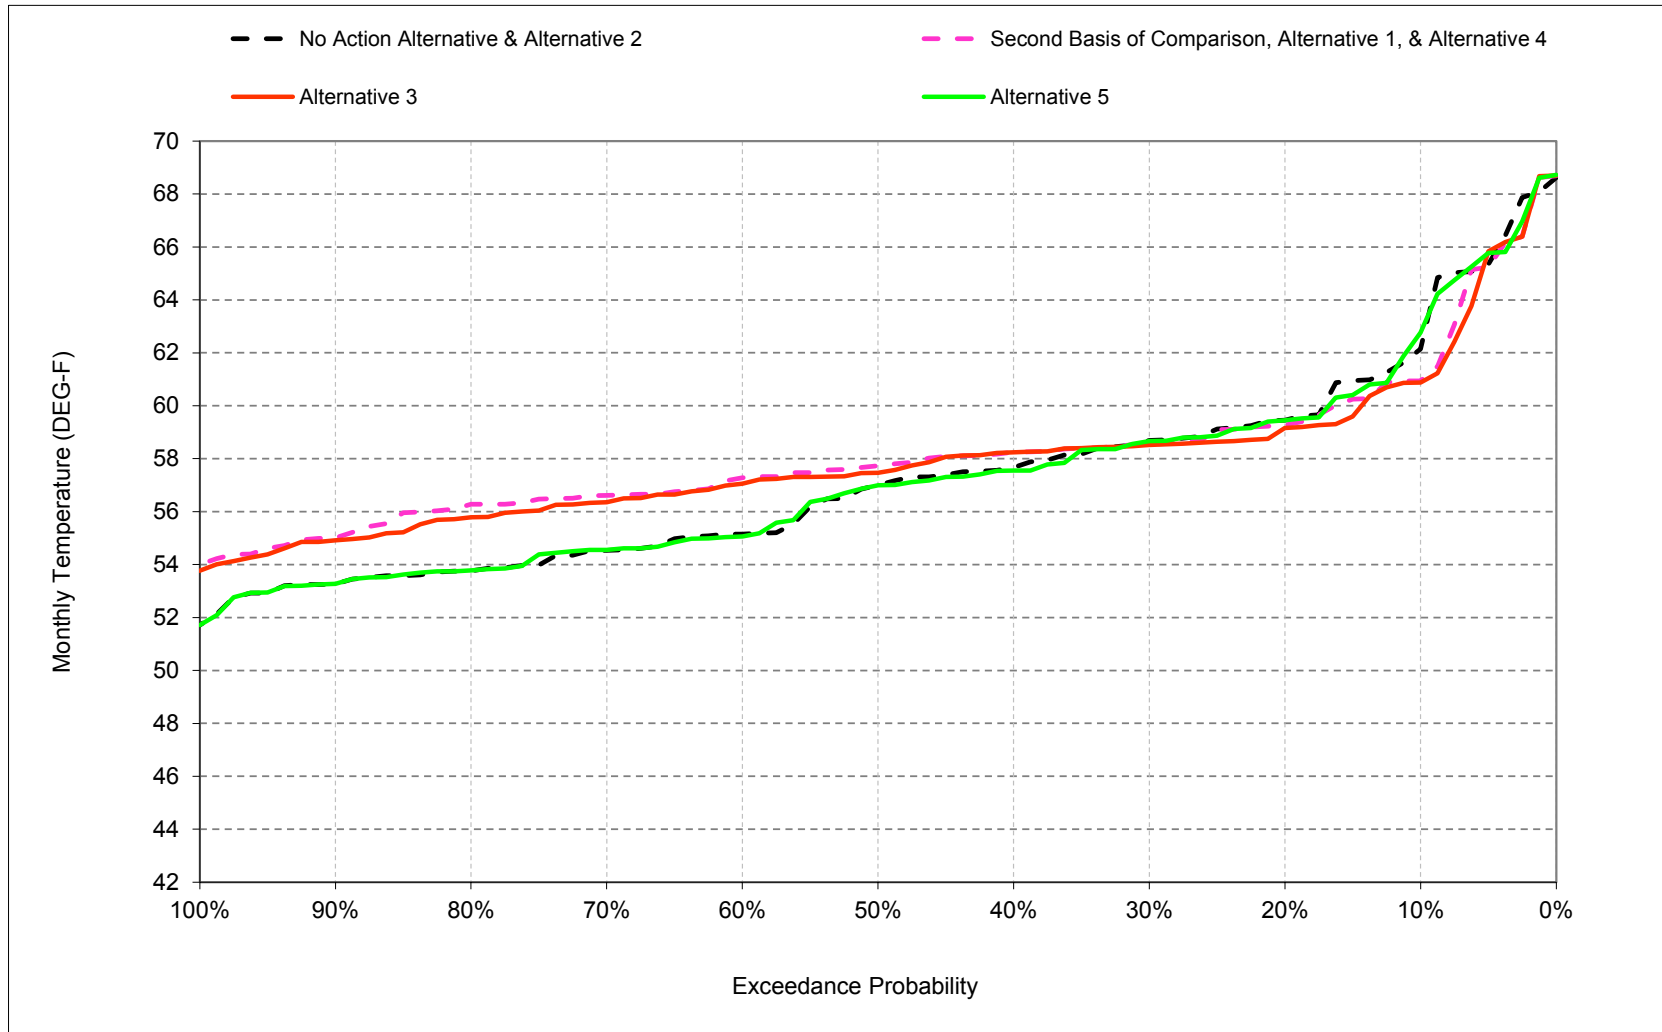

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-7-1. Sacramento River at Jellys Ferry, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	56	51	49	49	52	54	57	57	58	59	62
20%	57	55	51	48	48	51	54	56	57	57	58	59
30%	57	55	50	47	48	51	53	55	56	56	57	59
40%	56	55	50	47	48	50	53	55	55	56	57	58
50%	56	54	49	47	47	50	53	55	55	55	56	57
60%	56	54	49	46	47	49	52	55	55	55	56	55
70%	56	53	49	46	46	49	52	54	54	54	56	55
80%	55	53	48	46	46	48	51	54	54	54	56	54
90%	55	53	48	45	46	47	51	54	53	53	55	53
Long Term												
Full Simulation Period ^b	57	54	49	47	47	50	53	55	55	55	57	57
Water Year Types ^c												
Wet (32%)	54	52	47	46	47	48	52	55	55	55	56	54
Above Normal (16%)	57	54	49	47	47	49	52	55	54	54	55	55
Below Normal (13%)	56	54	50	47	48	50	53	54	55	55	56	58
Dry (24%)	57	54	50	47	48	50	53	55	55	55	58	59
Critical (15%)	59	55	50	47	48	51	53	56	57	58	61	64

Alternative 1												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	59	56	51	49	49	52	55	57	57	58	59	61
20%	57	55	51	48	49	51	54	56	56	57	58	59
30%	57	54	50	47	48	51	53	55	56	56	57	59
40%	56	54	49	47	48	50	53	55	55	56	57	58
50%	56	54	49	47	47	49	53	55	55	55	56	58
60%	56	53	49	46	47	49	52	54	54	55	56	57
70%	55	53	49	46	46	48	52	54	54	54	56	57
80%	55	53	48	46	46	48	51	54	54	54	55	56
90%	55	52	48	45	46	47	50	53	53	53	55	55
Long Term												
Full Simulation Period ^b	57	54	49	47	47	50	52	55	55	55	57	58
Water Year Types ^c												
Wet (32%)	54	51	47	47	47	48	52	55	55	55	56	56
Above Normal (16%)	57	54	49	47	47	49	52	55	54	54	55	57
Below Normal (13%)	56	53	49	47	48	50	53	54	54	55	56	58
Dry (24%)	57	54	49	47	48	50	53	55	54	55	58	59
Critical (15%)	59	55	50	47	48	51	53	56	57	58	61	63

Alternative 1 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-1.1	-0.3	0.1	0.0	0.1	-0.1	0.5	0.1	-0.4	0.0	0.5	-1.2
0.2	0.1	-0.4	-0.2	0.0	0.2	-0.2	-0.1	0.1	-0.2	-0.3	-0.4	-0.2
0.3	0.0	-0.5	-0.2	0.0	0.0	-0.1	-0.1	-0.1	0.0	0.1	-0.3	-0.1
0.4	0.0	-0.5	-0.2	0.1	0.0	-0.1	0.0	0.0	-0.2	-0.1	-0.1	0.6
0.5	0.2	-0.7	-0.1	0.0	0.0	-0.1	0.0	-0.2	-0.5	-0.1	-0.1	0.8
0.6	0.0	-0.6	0.1	0.0	-0.1	-0.1	0.0	-0.3	-0.3	0.1	-0.1	2.1
0.7	-0.2	-0.3	0.2	0.0	0.0	0.0	-0.1	-0.1	-0.3	0.1	-0.2	2.1
0.8	-0.1	-0.5	0.1	0.0	0.0	0.0	-0.3	-0.1	-0.4	0.1	-0.3	2.5
0.9	-0.1	-0.3	0.1	0.0	0.0	0.1	-0.1	-0.2	-0.2	0.0	-0.1	1.7
Long Term												
Full Simulation Period ^b	-0.1	-0.4	-0.1	0.0	0.0	0.0	-0.1	-0.1	-0.3	0.0	-0.2	0.9
Water Year Types ^c												
Wet (32%)	-0.1	-0.4	0.2	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	-0.3	2.5
Above Normal (16%)	0.0	-0.4	-0.2	0.1	0.0	-0.1	0.0	-0.2	-0.3	0.1	-0.2	1.8
Below Normal (13%)	-0.2	-0.5	-0.3	0.1	0.0	-0.3	-0.1	-0.1	-0.3	0.0	-0.4	-0.1
Dry (24%)	0.0	-0.3	-0.2	-0.1	0.0	0.0	-0.1	-0.2	-0.4	-0.1	0.1	-0.1
Critical (15%)	-0.5	-0.3	0.0	0.2	0.1	0.0	0.0	0.0	-0.4	-0.1	-0.4	-0.9

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-7-2. Sacramento River at Jellys Ferry, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	56	51	49	49	52	54	57	57	58	59	62
20%	57	55	51	48	48	51	54	56	57	57	58	59
30%	57	55	50	47	48	51	53	55	56	56	57	59
40%	56	55	50	47	48	50	53	55	55	56	57	58
50%	56	54	49	47	47	50	53	55	55	55	56	57
60%	56	54	49	46	47	49	52	55	55	55	56	55
70%	56	53	49	46	46	49	52	54	54	54	56	55
80%	55	53	48	46	46	48	51	54	54	54	56	54
90%	55	53	48	45	46	47	51	54	53	53	55	53
Long Term												
Full Simulation Period ^b	57	54	49	47	47	50	53	55	55	55	57	57
Water Year Types ^c												
Wet (32%)	54	52	47	46	47	48	52	55	55	55	56	54
Above Normal (16%)	57	54	49	47	47	49	52	55	54	54	55	55
Below Normal (13%)	56	54	50	47	48	50	53	54	55	55	56	58
Dry (24%)	57	54	50	47	48	50	53	55	55	55	58	59
Critical (15%)	59	55	50	47	48	51	53	56	57	58	61	64

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	60	56	51	48	49	52	55	57	57	58	59	61
20%	57	55	50	48	48	51	54	56	56	57	58	59
30%	57	54	50	47	48	51	53	55	56	56	57	59
40%	56	54	49	47	48	50	53	55	55	56	57	58
50%	56	54	49	47	47	49	53	55	55	55	56	57
60%	56	53	49	47	47	49	52	54	54	55	56	57
70%	56	53	49	46	46	48	52	54	54	54	56	56
80%	55	53	48	46	46	48	51	54	54	54	55	56
90%	55	52	48	45	46	47	51	53	53	54	55	55
Long Term												
Full Simulation Period ^b	57	54	49	47	47	50	53	55	55	55	57	58
Water Year Types ^c												
Wet (32%)	54	51	47	47	47	48	52	55	55	55	56	56
Above Normal (16%)	57	54	49	47	47	49	52	55	54	54	55	57
Below Normal (13%)	56	53	49	47	48	50	53	54	54	55	56	57
Dry (24%)	56	54	50	47	48	50	53	55	54	55	57	59
Critical (15%)	59	55	50	47	48	51	53	56	57	58	61	63

Alternative 3 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.9	-0.2	0.0	-0.1	0.0	-0.1	0.5	0.0	-0.3	0.0	-0.2	-1.2
0.2	0.0	-0.4	-0.2	0.1	0.1	-0.2	-0.1	0.1	-0.2	-0.3	-0.5	-0.4
0.3	0.0	-0.5	0.0	0.0	-0.1	0.0	-0.1	0.0	0.0	0.1	-0.2	-0.1
0.4	0.0	-0.5	-0.2	0.1	0.0	-0.1	-0.1	-0.1	-0.2	-0.2	0.0	0.6
0.5	0.1	-0.6	-0.2	-0.1	0.1	-0.1	0.0	-0.2	-0.4	0.0	0.0	0.5
0.6	0.0	-0.6	0.1	0.0	-0.1	0.0	0.0	-0.2	-0.3	0.1	-0.1	2.0
0.7	0.0	-0.3	0.0	0.1	0.1	0.0	0.0	-0.2	-0.3	0.2	-0.1	1.9
0.8	-0.2	-0.5	0.0	0.0	0.0	0.0	-0.2	0.0	-0.4	0.1	-0.1	2.0
0.9	-0.1	-0.2	0.2	0.0	0.0	0.1	0.0	-0.2	-0.2	0.1	-0.1	1.6
Long Term												
Full Simulation Period ^b	-0.2	-0.4	0.0	0.0	0.0	0.0	0.0	-0.1	-0.2	0.0	-0.2	0.7
Water Year Types ^c												
Wet (32%)	-0.1	-0.4	0.2	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	-0.2	2.3
Above Normal (16%)	0.0	-0.4	-0.2	0.0	0.0	-0.1	0.0	-0.2	-0.2	0.2	0.0	1.9
Below Normal (13%)	-0.2	-0.6	-0.3	0.1	0.0	-0.2	-0.1	-0.1	-0.2	-0.1	-0.1	-0.9
Dry (24%)	-0.1	-0.4	-0.1	-0.1	0.0	0.0	-0.1	-0.1	-0.4	-0.1	-0.2	-0.2
Critical (15%)	-0.4	-0.2	0.0	0.1	0.1	0.0	0.1	0.0	-0.3	0.1	-0.5	-1.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-7-3. Sacramento River at Jellys Ferry, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	56	51	49	49	52	54	57	57	58	59	62
20%	57	55	51	48	48	51	54	56	57	57	58	59
30%	57	55	50	47	48	51	53	55	56	56	57	59
40%	56	55	50	47	48	50	53	55	55	56	57	58
50%	56	54	49	47	47	50	53	55	55	55	56	57
60%	56	54	49	46	47	49	52	55	55	55	56	55
70%	56	53	49	46	46	49	52	54	54	54	56	55
80%	55	53	48	46	46	48	51	54	54	54	56	54
90%	55	53	48	45	46	47	51	54	53	53	55	53
Long Term												
Full Simulation Period ^b	57	54	49	47	47	50	53	55	55	55	57	57
Water Year Types ^c												
Wet (32%)	54	52	47	46	47	48	52	55	55	55	56	54
Above Normal (16%)	57	54	49	47	47	49	52	55	54	54	55	55
Below Normal (13%)	56	54	50	47	48	50	53	54	55	55	56	58
Dry (24%)	57	54	50	47	48	50	53	55	55	55	58	59
Critical (15%)	59	55	50	47	48	51	53	56	57	58	61	64

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	56	51	49	49	52	54	57	57	58	59	63
20%	57	55	51	48	48	51	54	56	57	57	58	59
30%	57	55	50	47	48	51	53	56	56	56	57	59
40%	56	55	50	47	48	50	53	55	55	56	57	58
50%	56	54	49	47	47	50	53	55	55	55	56	57
60%	56	54	49	46	47	49	52	55	55	55	56	55
70%	55	53	49	46	46	49	52	54	54	54	56	55
80%	55	53	48	46	46	48	51	54	54	54	56	54
90%	55	53	48	45	46	47	51	54	53	53	55	53
Long Term												
Full Simulation Period ^b	57	54	49	47	47	50	53	55	55	55	57	57
Water Year Types ^c												
Wet (32%)	54	52	47	46	47	48	52	55	55	55	56	54
Above Normal (16%)	57	54	49	47	47	49	52	55	54	54	55	55
Below Normal (13%)	56	54	50	47	48	50	53	54	55	55	56	58
Dry (24%)	57	54	50	47	48	50	53	55	55	55	57	59
Critical (15%)	59	56	50	47	48	51	53	56	57	58	61	64

Alternative 5 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.4	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.2	0.0	-0.1	0.6
0.2	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.0	-0.2	0.0
0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.1	-0.2	0.0
0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	-0.1	-0.1	0.0	-0.1
0.5	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	-0.1	0.0	0.0
0.6	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	-0.1
0.7	-0.2	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.0	0.0	0.0	0.0
0.8	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.2	-0.1	0.0	0.0	0.0
0.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.1	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	-0.1	-0.1	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.1
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.1	-0.1
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.0	-0.1	-0.2	-0.2
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	-0.2	-0.2	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-7-4. Sacramento River at Jellys Ferry, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	59	56	51	49	49	52	55	57	57	58	59	61
20%	57	55	51	48	49	51	54	56	56	57	58	59
30%	57	54	50	47	48	51	53	55	56	56	57	59
40%	56	54	49	47	48	50	53	55	55	56	57	58
50%	56	54	49	47	47	49	53	55	55	55	56	58
60%	56	53	49	46	47	49	52	54	54	55	56	57
70%	55	53	49	46	46	48	52	54	54	54	56	57
80%	55	53	48	46	46	48	51	54	54	54	55	56
90%	55	52	48	45	46	47	50	53	53	53	55	55
Long Term												
Full Simulation Period ^b	57	54	49	47	47	50	52	55	55	55	57	58
Water Year Types ^c												
Wet (32%)	54	51	47	47	47	48	52	55	55	55	56	56
Above Normal (16%)	57	54	49	47	47	49	52	55	54	54	55	57
Below Normal (13%)	56	53	49	47	48	50	53	54	54	55	56	58
Dry (24%)	57	54	49	47	48	50	53	55	54	55	58	59
Critical (15%)	59	55	50	47	48	51	53	56	57	58	61	63

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	56	51	49	49	52	54	57	57	58	59	62
20%	57	55	51	48	48	51	54	56	57	57	58	59
30%	57	55	50	47	48	51	53	55	56	56	57	59
40%	56	55	50	47	48	50	53	55	55	56	57	58
50%	56	54	49	47	47	50	53	55	55	55	56	57
60%	56	54	49	46	47	49	52	55	55	55	56	55
70%	56	53	49	46	46	49	52	54	54	54	56	55
80%	55	53	48	46	46	48	51	54	54	54	56	54
90%	55	53	48	45	46	47	51	54	53	53	55	53
Long Term												
Full Simulation Period ^b	57	54	49	47	47	50	53	55	55	55	57	57
Water Year Types ^c												
Wet (32%)	54	52	47	46	47	48	52	55	55	55	56	54
Above Normal (16%)	57	54	49	47	47	49	52	55	54	54	55	55
Below Normal (13%)	56	54	50	47	48	50	53	54	55	55	56	58
Dry (24%)	57	54	50	47	48	50	53	55	55	55	58	59
Critical (15%)	59	55	50	47	48	51	53	56	57	58	61	64

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	1.1	0.3	-0.1	0.0	-0.1	0.1	-0.5	-0.1	0.4	0.0	-0.5	1.2
0.2	-0.1	0.4	0.2	0.0	-0.2	0.2	0.1	-0.1	0.2	0.3	0.4	0.2
0.3	0.0	0.5	0.2	0.0	0.0	0.1	0.1	0.1	0.0	-0.1	0.3	0.1
0.4	0.0	0.5	0.2	-0.1	0.0	0.1	0.0	0.0	0.2	0.1	0.1	-0.6
0.5	-0.2	0.7	0.1	0.0	0.0	0.1	0.0	0.2	0.5	0.1	0.1	-0.8
0.6	0.0	0.6	-0.1	0.0	0.1	0.1	0.0	0.3	0.3	-0.1	0.1	-2.1
0.7	0.2	0.3	-0.2	0.0	0.0	0.0	0.1	0.1	0.3	-0.1	0.2	-2.1
0.8	0.1	0.5	-0.1	0.0	0.0	0.0	0.3	0.1	0.4	-0.1	0.3	-2.5
0.9	0.1	0.3	-0.1	0.0	0.0	-0.1	0.1	0.2	0.2	0.0	0.1	-1.7
Long Term												
Full Simulation Period ^b	0.1	0.4	0.1	0.0	0.0	0.0	0.1	0.1	0.3	0.0	0.2	-0.9
Water Year Types ^c												
Wet (32%)	0.1	0.4	-0.2	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.3	-2.5
Above Normal (16%)	0.0	0.4	0.2	-0.1	0.0	0.1	0.0	0.2	0.3	-0.1	0.2	-1.8
Below Normal (13%)	0.2	0.5	0.3	-0.1	0.0	0.3	0.1	0.1	0.3	0.0	0.4	0.1
Dry (24%)	0.0	0.3	0.2	0.1	0.0	0.0	0.1	0.2	0.4	0.1	-0.1	0.1
Critical (15%)	0.5	0.3	0.0	-0.2	-0.1	0.0	0.0	0.0	0.4	0.1	0.4	0.9

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-7-5. Sacramento River at Jellys Ferry, Monthly Temperature

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	59	56	51	49	49	52	55	57	57	58	59	61
20%	57	55	51	48	49	51	54	56	56	57	58	59
30%	57	54	50	47	48	51	53	55	56	56	57	59
40%	56	54	49	47	48	50	53	55	55	56	57	58
50%	56	54	49	47	47	49	53	55	55	55	56	58
60%	56	53	49	46	47	49	52	54	54	55	56	57
70%	55	53	49	46	46	48	52	54	54	54	56	57
80%	55	53	48	46	46	48	51	54	54	54	55	56
90%	55	52	48	45	46	47	50	53	53	53	55	55
Long Term												
Full Simulation Period ^b	57	54	49	47	47	50	52	55	55	55	57	58
Water Year Types ^c												
Wet (32%)	54	51	47	47	47	48	52	55	55	55	56	56
Above Normal (16%)	57	54	49	47	47	49	52	55	54	54	55	57
Below Normal (13%)	56	53	49	47	48	50	53	54	54	55	56	58
Dry (24%)	57	54	49	47	48	50	53	55	54	55	58	59
Critical (15%)	59	55	50	47	48	51	53	56	57	58	61	63

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 3												
Probability of Exceedance ^a												
10%	60	56	51	48	49	52	55	57	57	58	59	61
20%	57	55	50	48	48	51	54	56	56	57	58	59
30%	57	54	50	47	48	51	53	55	56	56	57	59
40%	56	54	49	47	48	50	53	55	55	56	57	58
50%	56	54	49	47	47	49	53	55	55	55	56	57
60%	56	53	49	47	47	49	52	54	54	55	56	57
70%	56	53	49	46	46	48	52	54	54	54	56	56
80%	55	53	48	46	46	48	51	54	54	54	55	56
90%	55	52	48	45	46	47	51	53	53	54	55	55
Long Term												
Full Simulation Period ^b	57	54	49	47	47	50	53	55	55	55	57	58
Water Year Types ^c												
Wet (32%)	54	51	47	47	47	48	52	55	55	55	56	56
Above Normal (16%)	57	54	49	47	47	49	52	55	54	54	55	57
Below Normal (13%)	56	53	49	47	48	50	53	54	54	55	56	57
Dry (24%)	56	54	50	47	48	50	53	55	54	55	57	59
Critical (15%)	59	55	50	47	48	51	53	56	57	58	61	63

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 3 minus Second Basis of Comparison												
Probability of Exceedance ^a												
0.1	0.2	0.1	0.0	-0.1	-0.1	0.0	0.0	-0.1	0.1	0.0	-0.8	-0.1
0.2	-0.1	0.0	0.0	0.1	-0.1	0.0	0.1	0.0	0.1	0.0	0.0	-0.2
0.3	0.0	0.0	0.1	0.0	-0.1	0.0	0.0	0.1	0.0	0.0	0.0	0.0
0.4	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.0	-0.1	0.1	0.0
0.5	-0.1	0.2	-0.1	0.0	0.0	0.0	0.1	0.0	0.1	0.1	0.0	-0.2
0.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.2
0.7	0.1	0.0	-0.1	0.0	0.1	0.0	0.1	-0.1	0.0	0.0	0.1	-0.2
0.8	-0.1	0.0	0.0	0.1	0.0	0.0	0.1	0.1	0.0	0.1	0.1	-0.5
0.9	0.0	0.0	0.1	0.0	0.0	0.0	0.1	0.0	0.0	0.1	0.0	-0.1
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.2
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	-0.2
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.2	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.1	0.0	0.3	-0.8
Dry (24%)	-0.2	-0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	-0.2	-0.1
Critical (15%)	0.1	0.1	0.0	-0.1	-0.1	0.0	0.0	0.0	0.1	0.1	-0.1	-0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-7-6. Sacramento River at Jellys Ferry, Monthly Temperature

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	59	56	51	49	49	52	55	57	57	58	59	61
20%	57	55	51	48	49	51	54	56	56	57	58	59
30%	57	54	50	47	48	51	53	55	56	56	57	59
40%	56	54	49	47	48	50	53	55	55	56	57	58
50%	56	54	49	47	47	49	53	55	55	55	56	58
60%	56	53	49	46	47	49	52	54	54	55	56	57
70%	55	53	49	46	46	48	52	54	54	54	56	57
80%	55	53	48	46	46	48	51	54	54	54	55	56
90%	55	52	48	45	46	47	50	53	53	53	55	55
Long Term												
Full Simulation Period ^b	57	54	49	47	47	50	52	55	55	55	57	58
Water Year Types ^c												
Wet (32%)	54	51	47	47	47	48	52	55	55	55	56	56
Above Normal (16%)	57	54	49	47	47	49	52	55	54	54	55	57
Below Normal (13%)	56	53	49	47	48	50	53	54	54	55	56	58
Dry (24%)	57	54	49	47	48	50	53	55	54	55	58	59
Critical (15%)	59	55	50	47	48	51	53	56	57	58	61	63

Alternative 5

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	56	51	49	49	52	54	57	57	58	59	63
20%	57	55	51	48	48	51	54	56	57	57	58	59
30%	57	55	50	47	48	51	53	56	56	56	57	59
40%	56	55	50	47	48	50	53	55	55	56	57	58
50%	56	54	49	47	47	50	53	55	55	55	56	57
60%	56	54	49	46	47	49	52	55	55	55	56	55
70%	55	53	49	46	46	49	52	54	54	54	56	55
80%	55	53	48	46	46	48	51	54	54	54	56	54
90%	55	53	48	45	46	47	51	54	53	53	55	53
Long Term												
Full Simulation Period ^b	57	54	49	47	47	50	53	55	55	55	57	57
Water Year Types ^c												
Wet (32%)	54	52	47	46	47	48	52	55	55	55	56	54
Above Normal (16%)	57	54	49	47	47	49	52	55	54	54	55	55
Below Normal (13%)	56	54	50	47	48	50	53	54	55	55	56	58
Dry (24%)	57	54	50	47	48	50	53	55	55	55	57	59
Critical (15%)	59	56	50	47	48	51	53	56	57	58	61	64

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	1.5	0.3	-0.1	0.0	-0.1	0.0	-0.4	-0.1	0.5	0.0	-0.6	1.7
0.2	-0.2	0.3	0.2	0.1	-0.2	0.2	0.2	0.0	0.2	0.3	0.2	0.2
0.3	0.0	0.5	0.2	0.0	0.0	0.1	0.1	0.2	0.0	0.0	0.1	0.1
0.4	0.0	0.5	0.2	-0.1	0.0	0.1	0.1	0.1	0.1	0.0	0.1	-0.7
0.5	-0.1	0.7	0.1	0.0	-0.1	0.1	0.1	0.3	0.5	0.0	0.1	-0.8
0.6	0.0	0.5	-0.1	0.0	0.1	0.1	0.0	0.2	0.3	-0.2	0.1	-2.2
0.7	0.0	0.4	-0.2	-0.1	0.0	0.1	0.2	0.3	0.3	-0.2	0.2	-2.0
0.8	0.0	0.5	0.0	0.0	0.1	0.0	0.3	0.3	0.3	-0.1	0.2	-2.5
0.9	0.1	0.3	-0.1	0.0	0.0	-0.1	0.1	0.3	0.2	0.0	0.2	-1.7
Long Term												
Full Simulation Period ^b	0.1	0.4	0.0	0.0	0.0	0.0	0.1	0.2	0.3	0.0	0.2	-0.9
Water Year Types ^c												
Wet (32%)	0.1	0.4	-0.2	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.3	-2.5
Above Normal (16%)	0.0	0.3	0.2	-0.1	0.0	0.1	0.0	0.3	0.3	-0.1	0.2	-1.8
Below Normal (13%)	0.2	0.5	0.3	0.0	0.0	0.2	0.1	0.2	0.3	0.0	0.6	0.0
Dry (24%)	0.0	0.3	0.2	0.1	0.0	0.0	0.2	0.4	0.4	0.0	-0.3	0.0
Critical (15%)	0.6	0.3	0.0	-0.2	-0.2	0.0	0.1	0.2	0.5	-0.1	0.2	0.9

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


B.8. Sacramento River at Bend Bridge Temperature

Figure B-8-1. Sacramento River at Bend Bridge, October

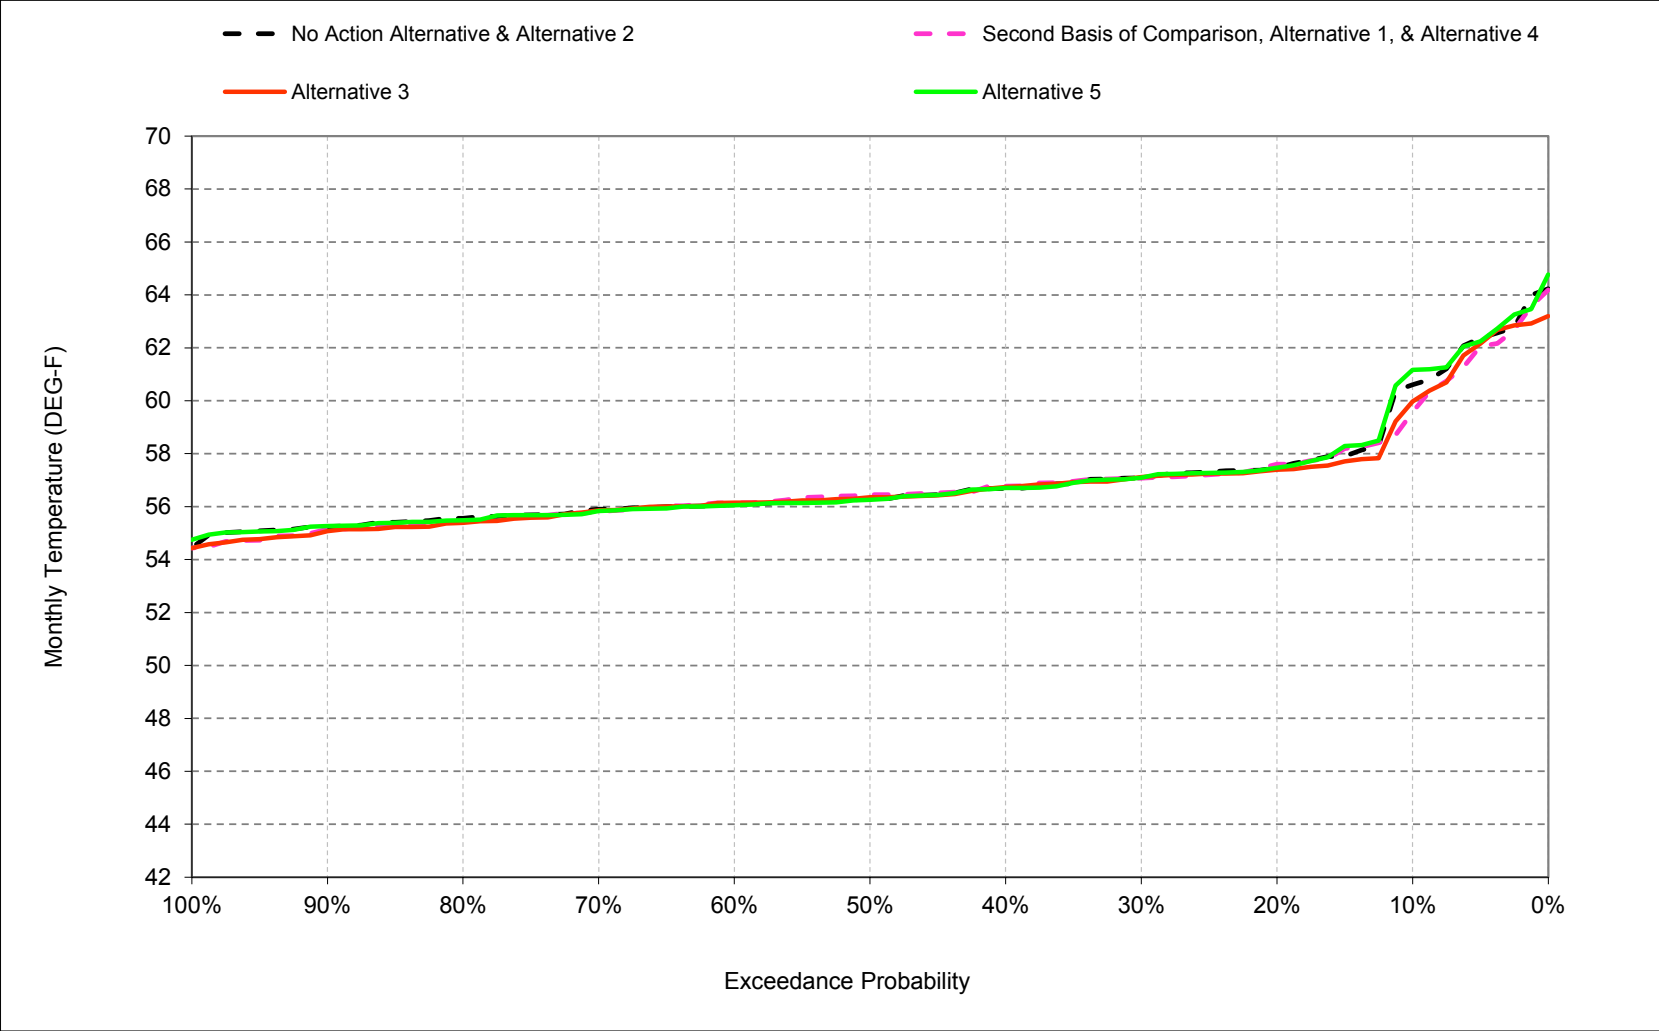


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-8-2. Sacramento River at Bend Bridge, November

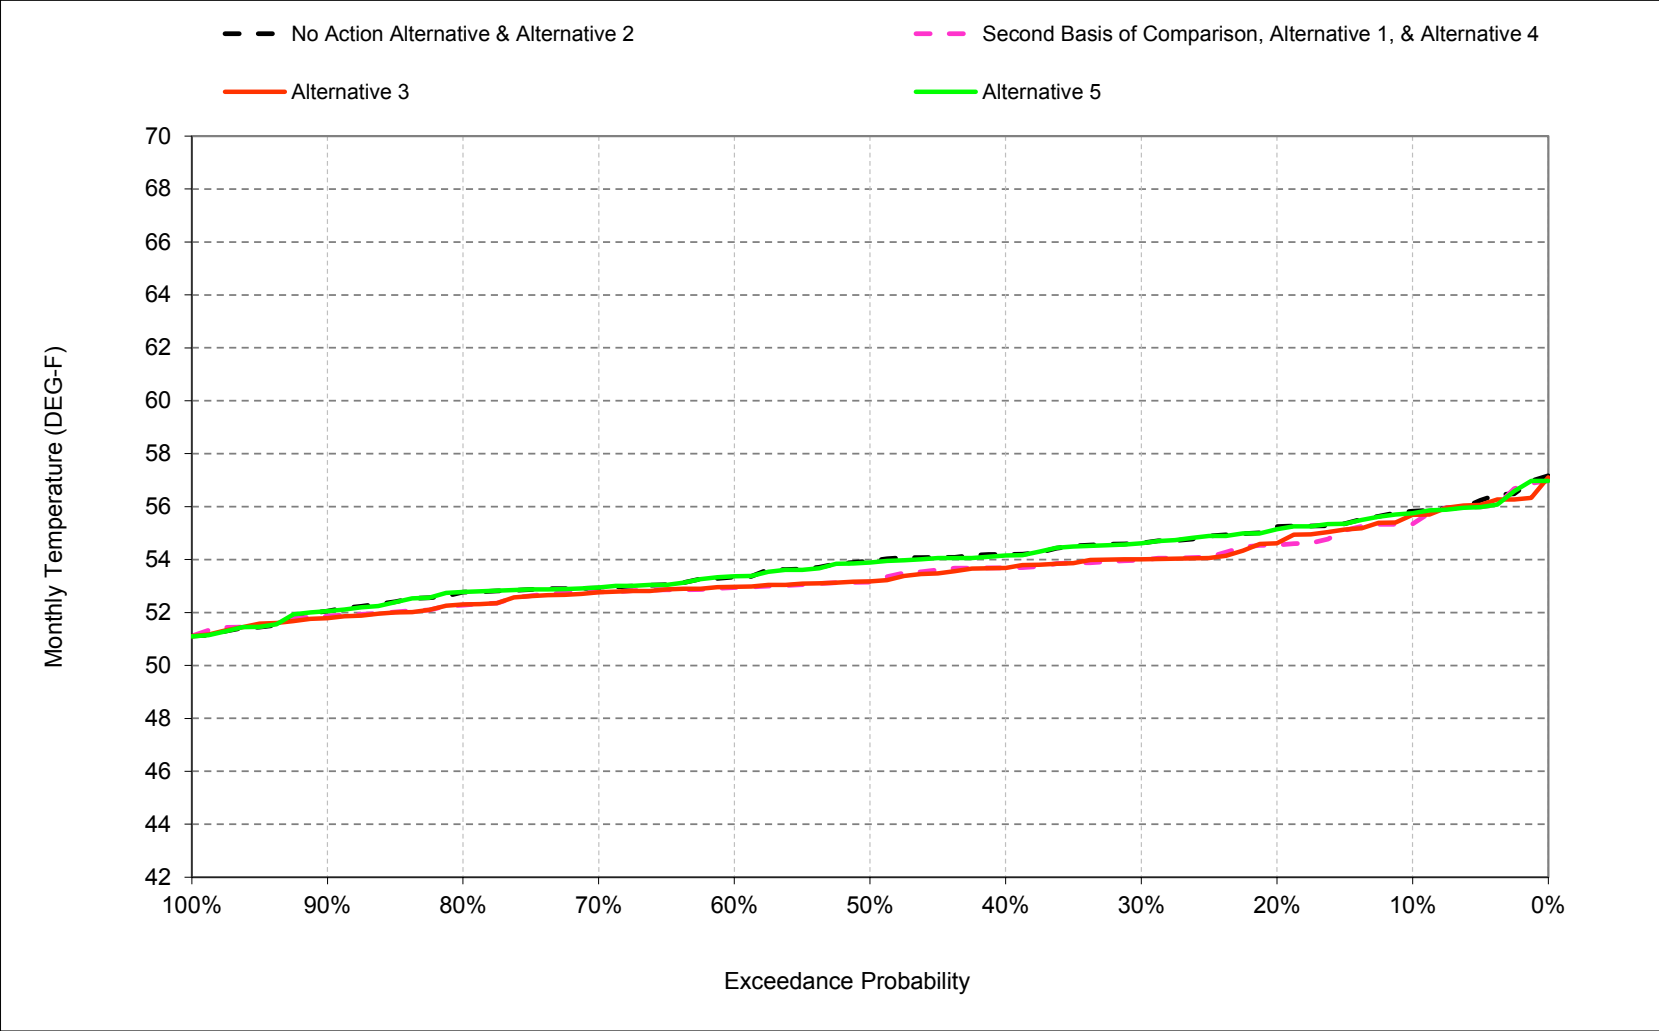


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-8-3. Sacramento River at Bend Bridge, December

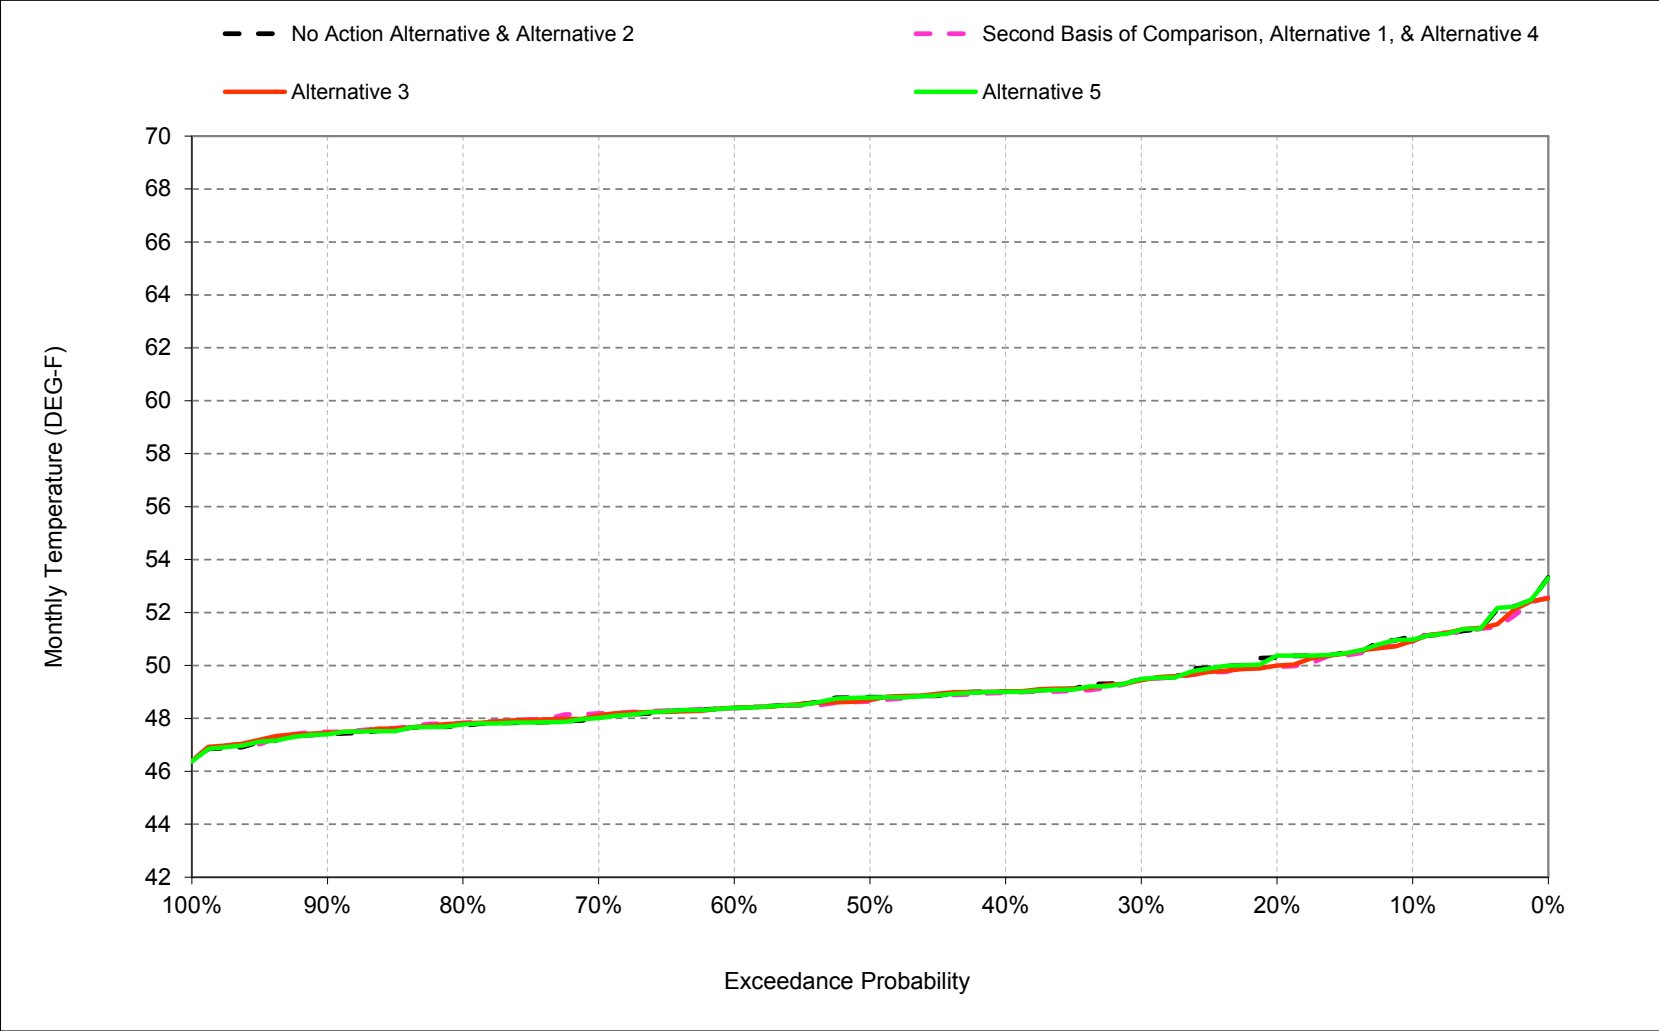


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-8-4. Sacramento River at Bend Bridge, January

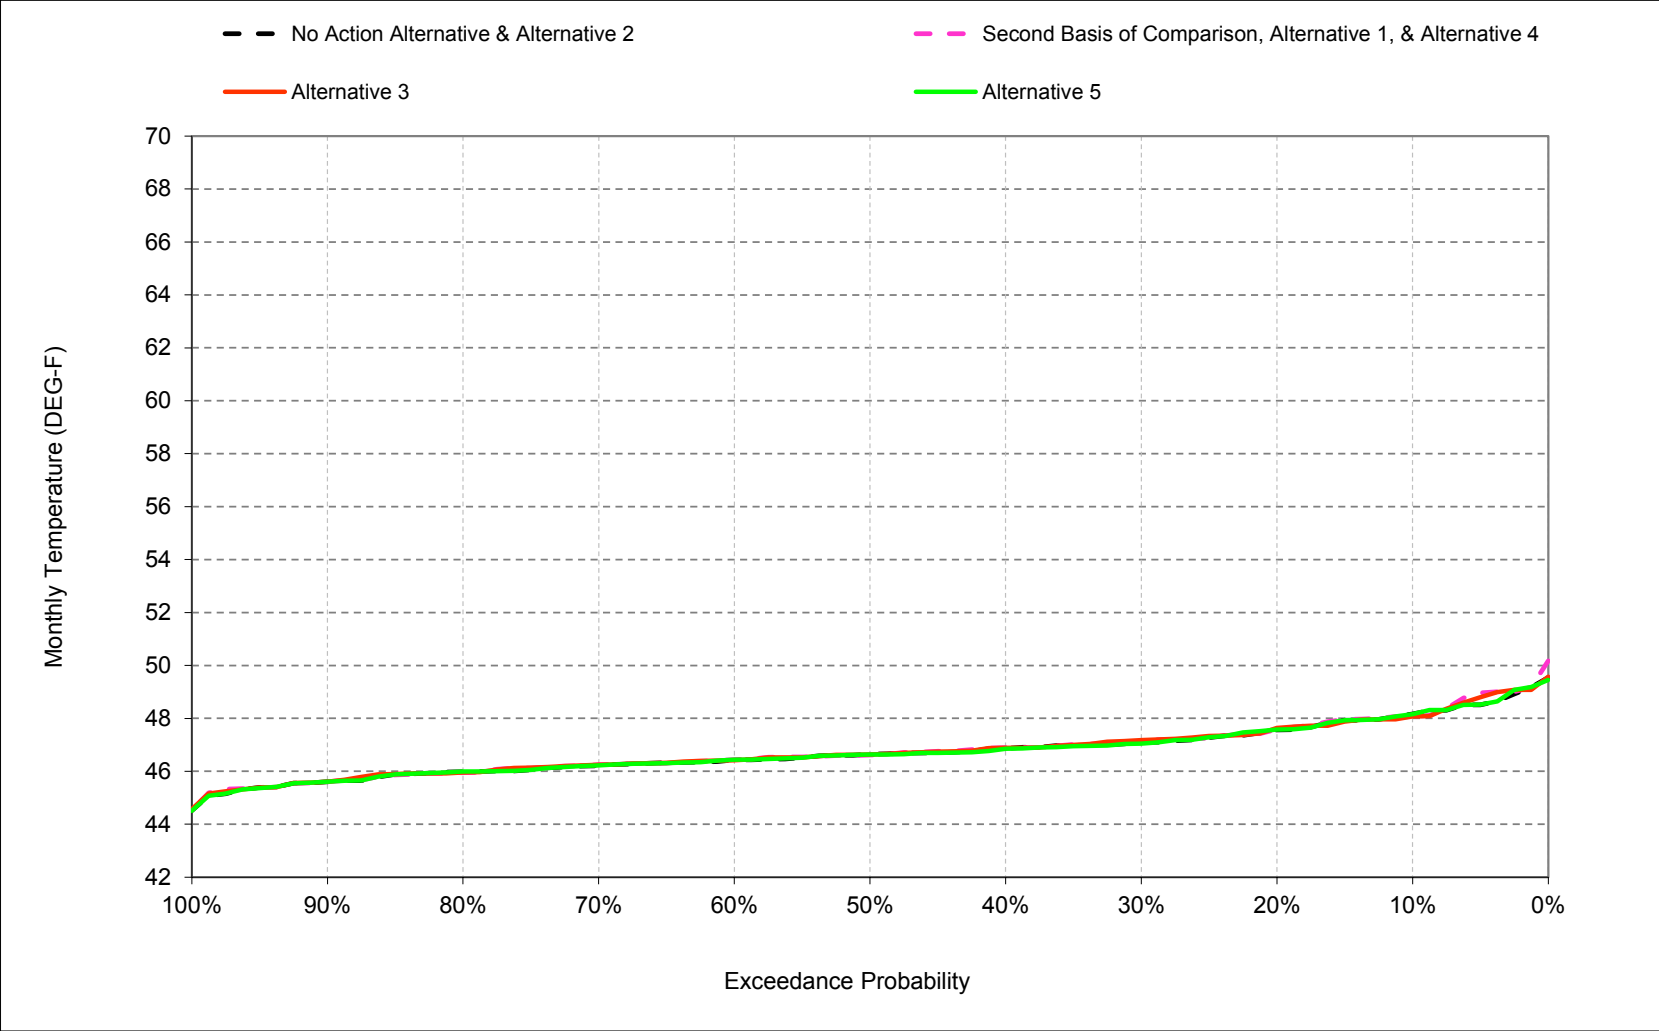


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-8-5. Sacramento River at Bend Bridge, February

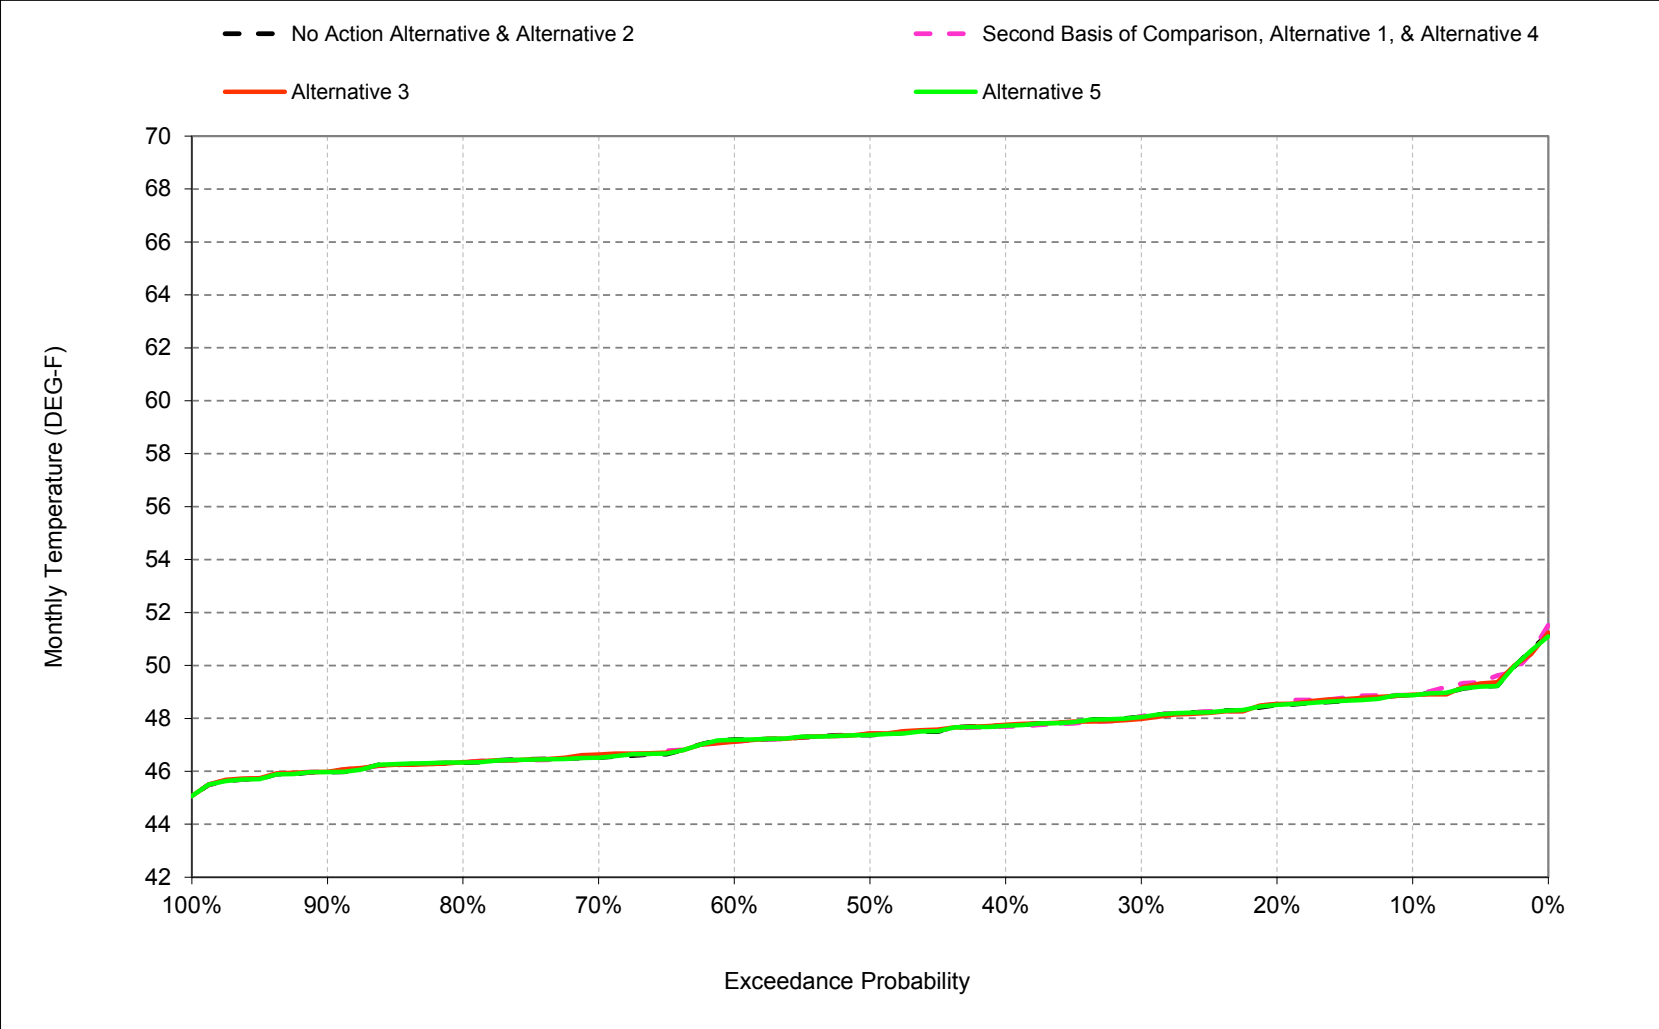


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-8-6. Sacramento River at Bend Bridge, March

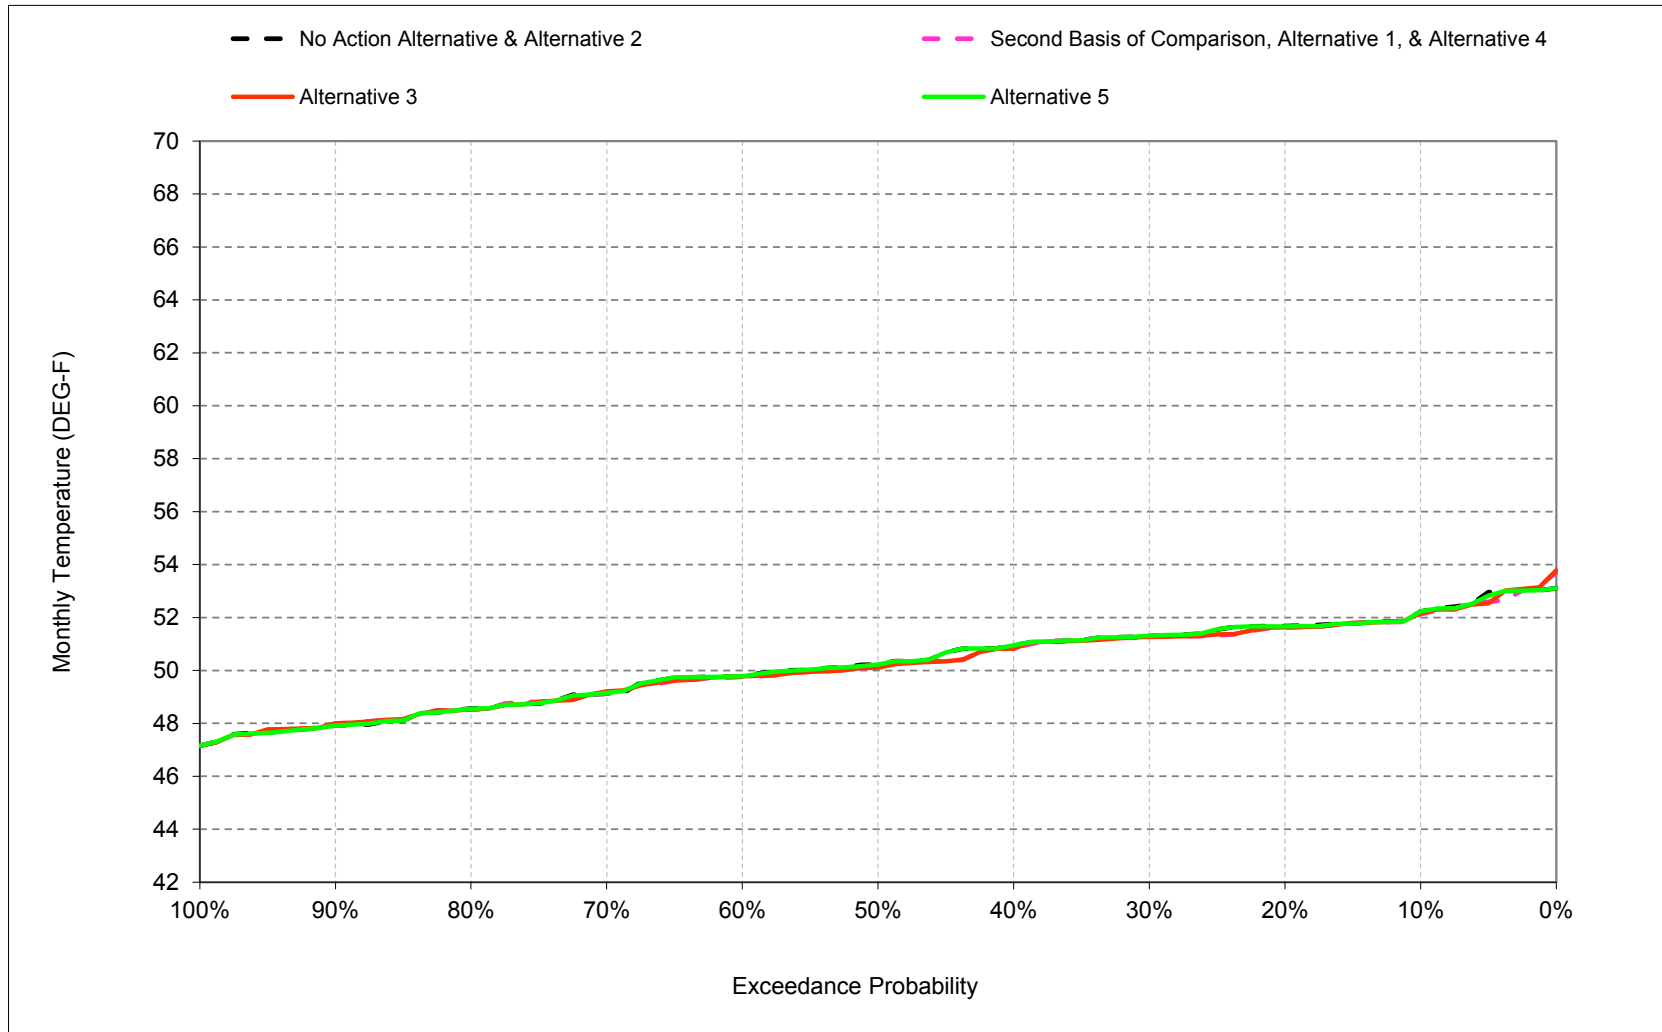


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-8-7. Sacramento River at Bend Bridge, April

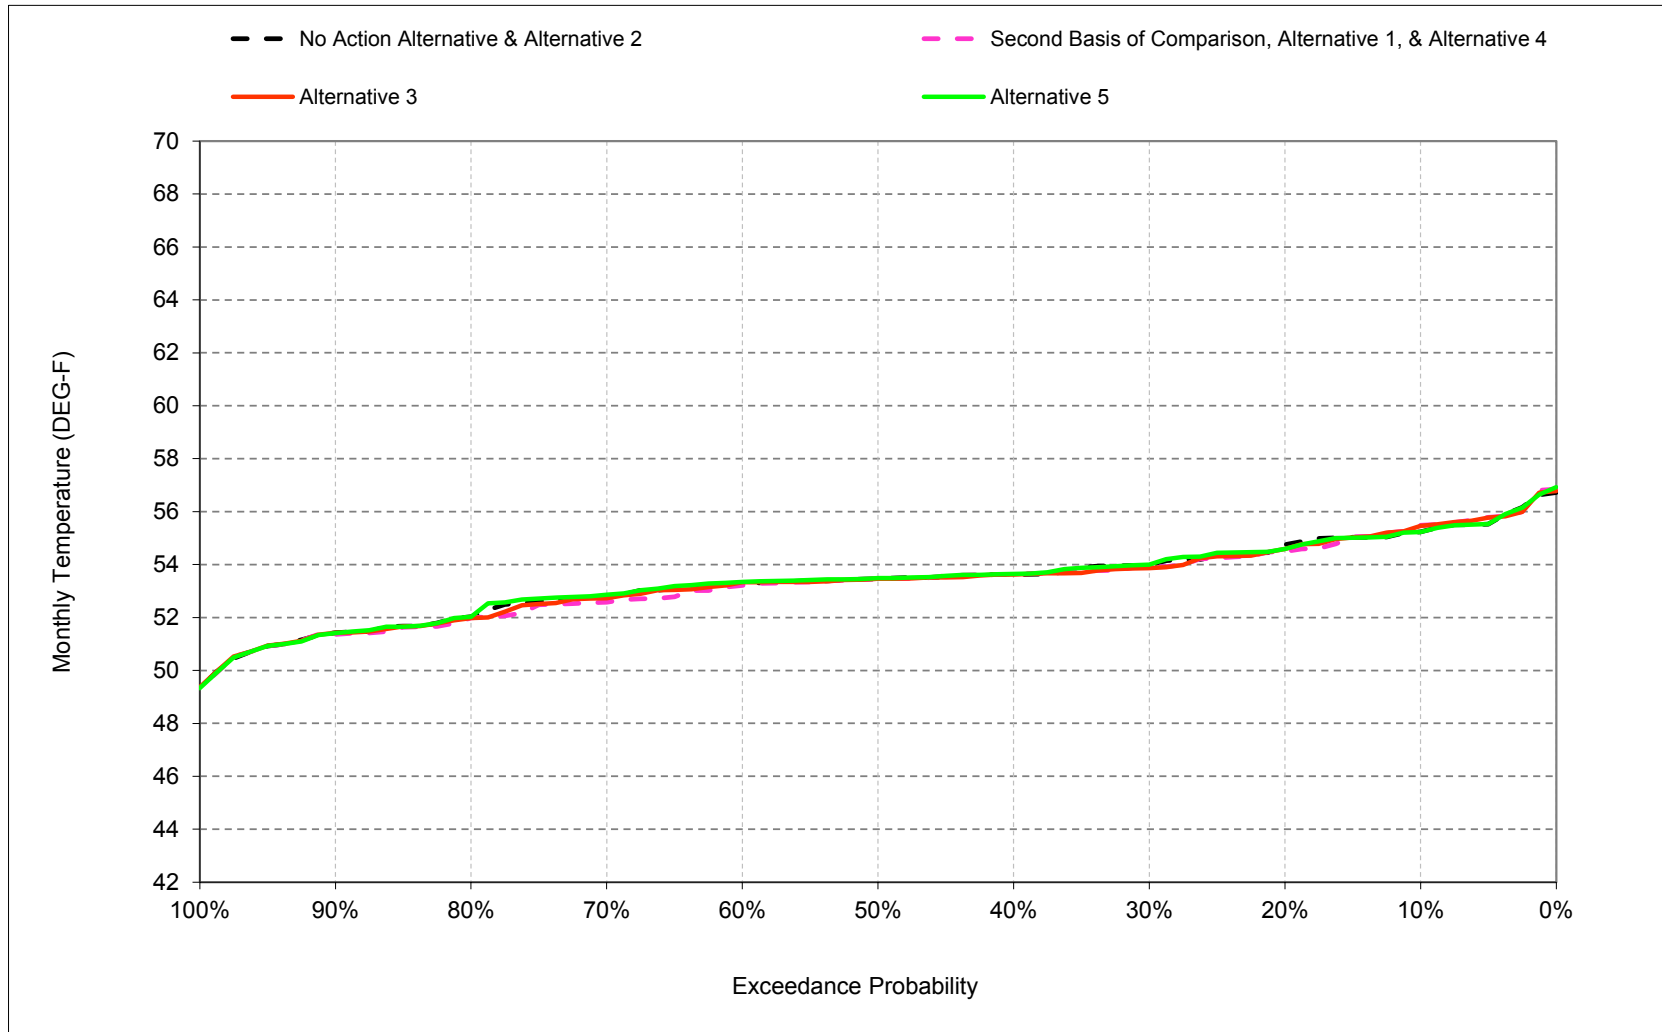


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-8-8. Sacramento River at Bend Bridge, May

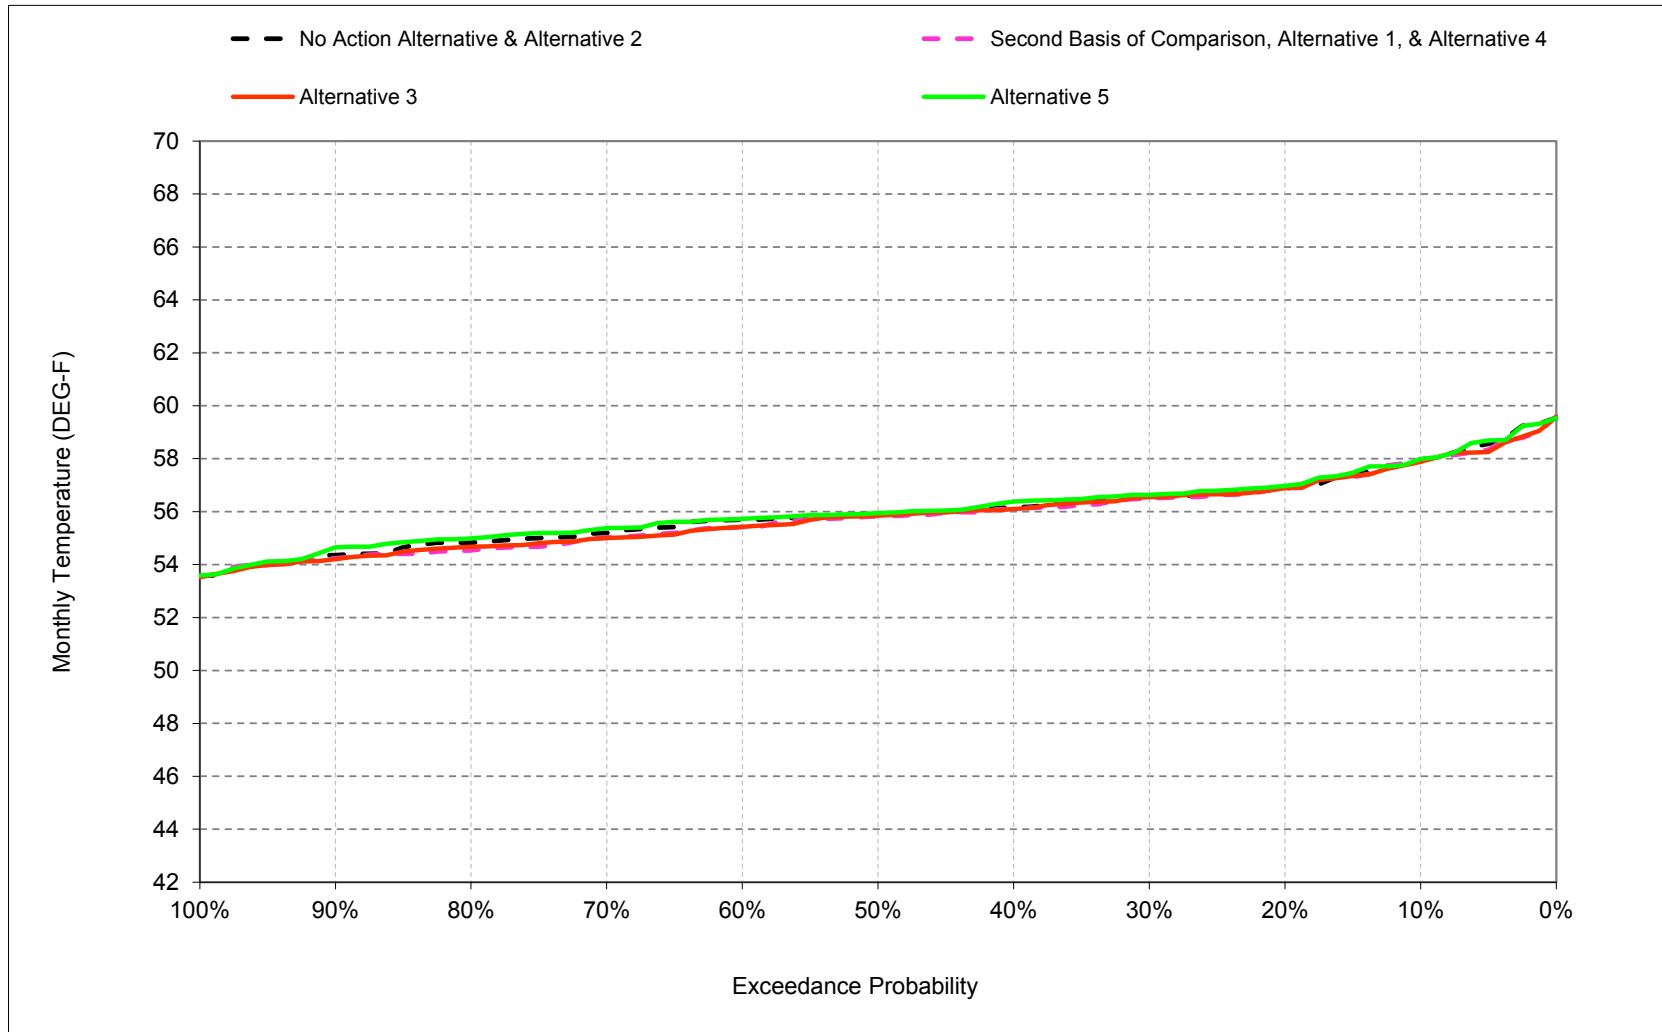


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-8-9. Sacramento River at Bend Bridge, June

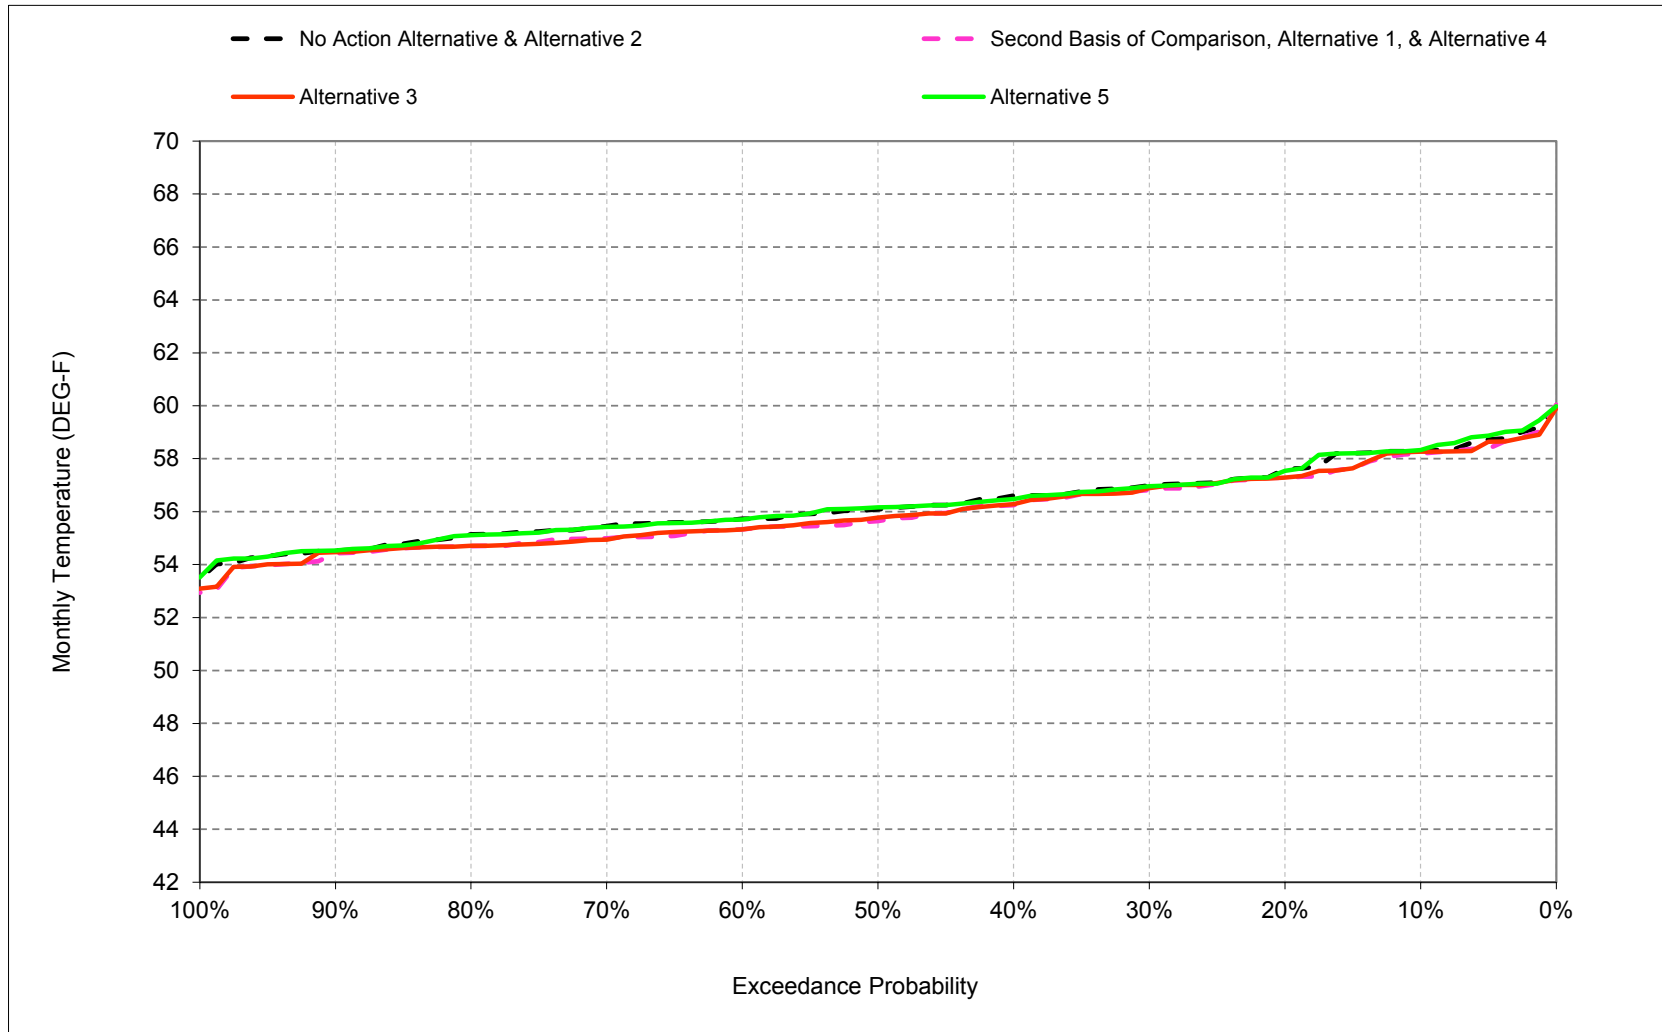


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-8-10. Sacramento River at Bend Bridge, July

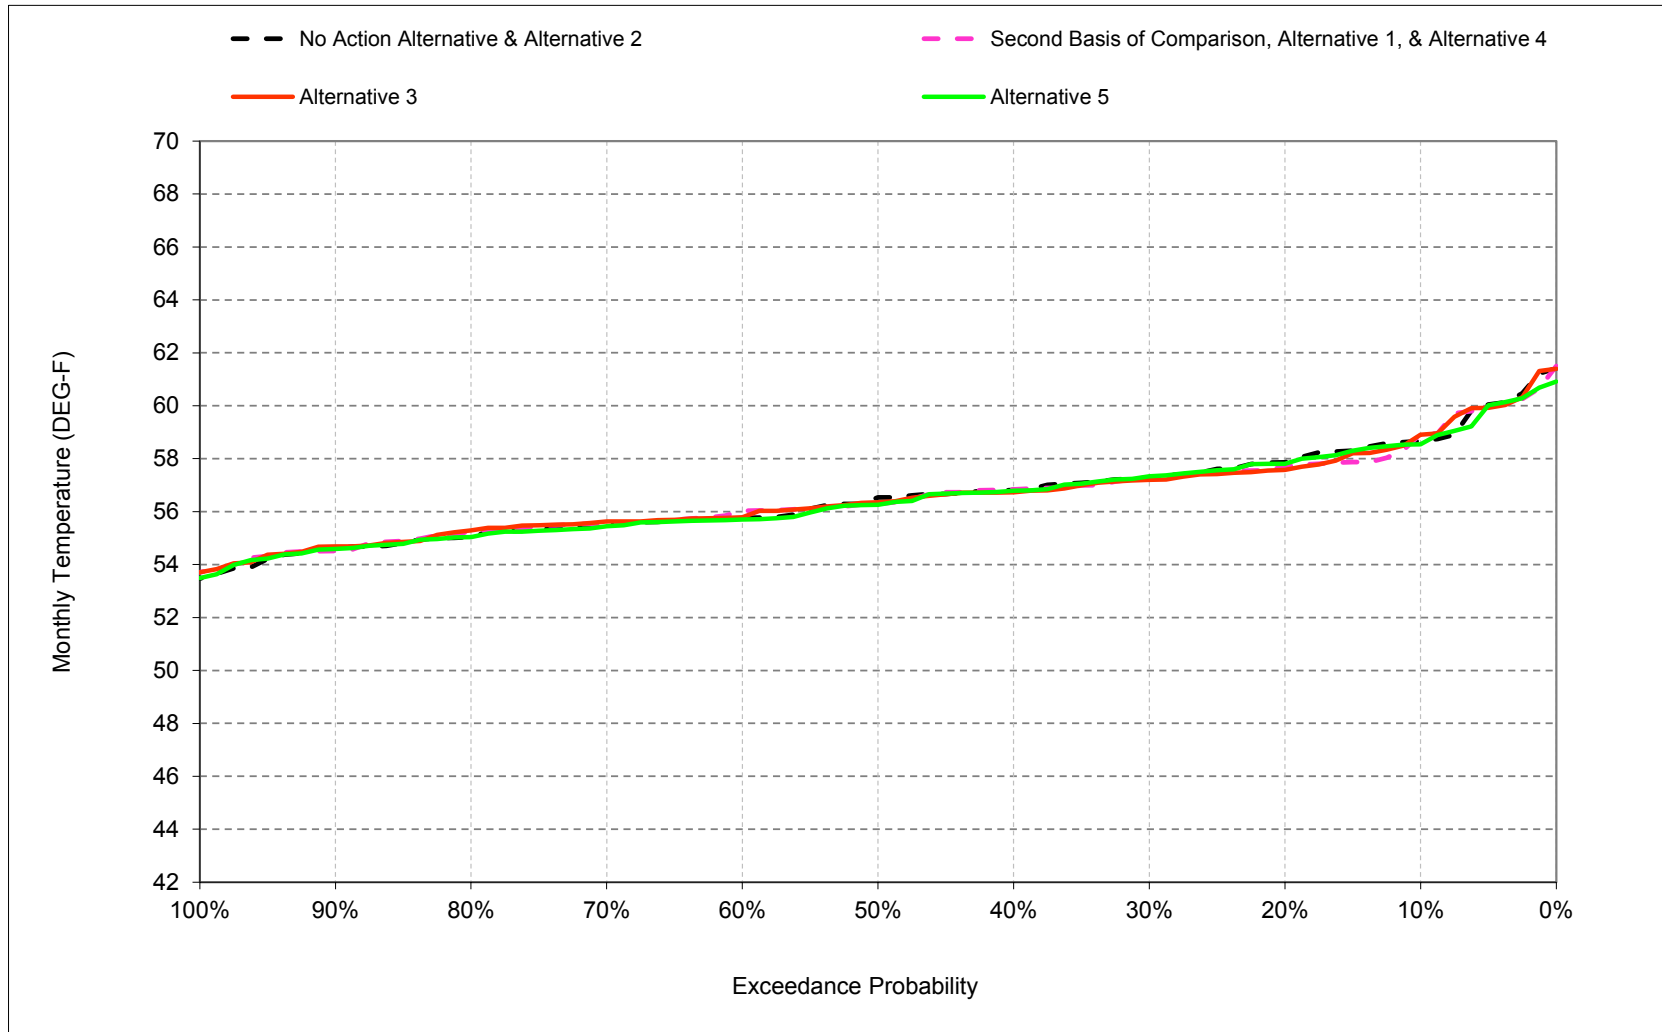


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-8-11. Sacramento River at Bend Bridge, August

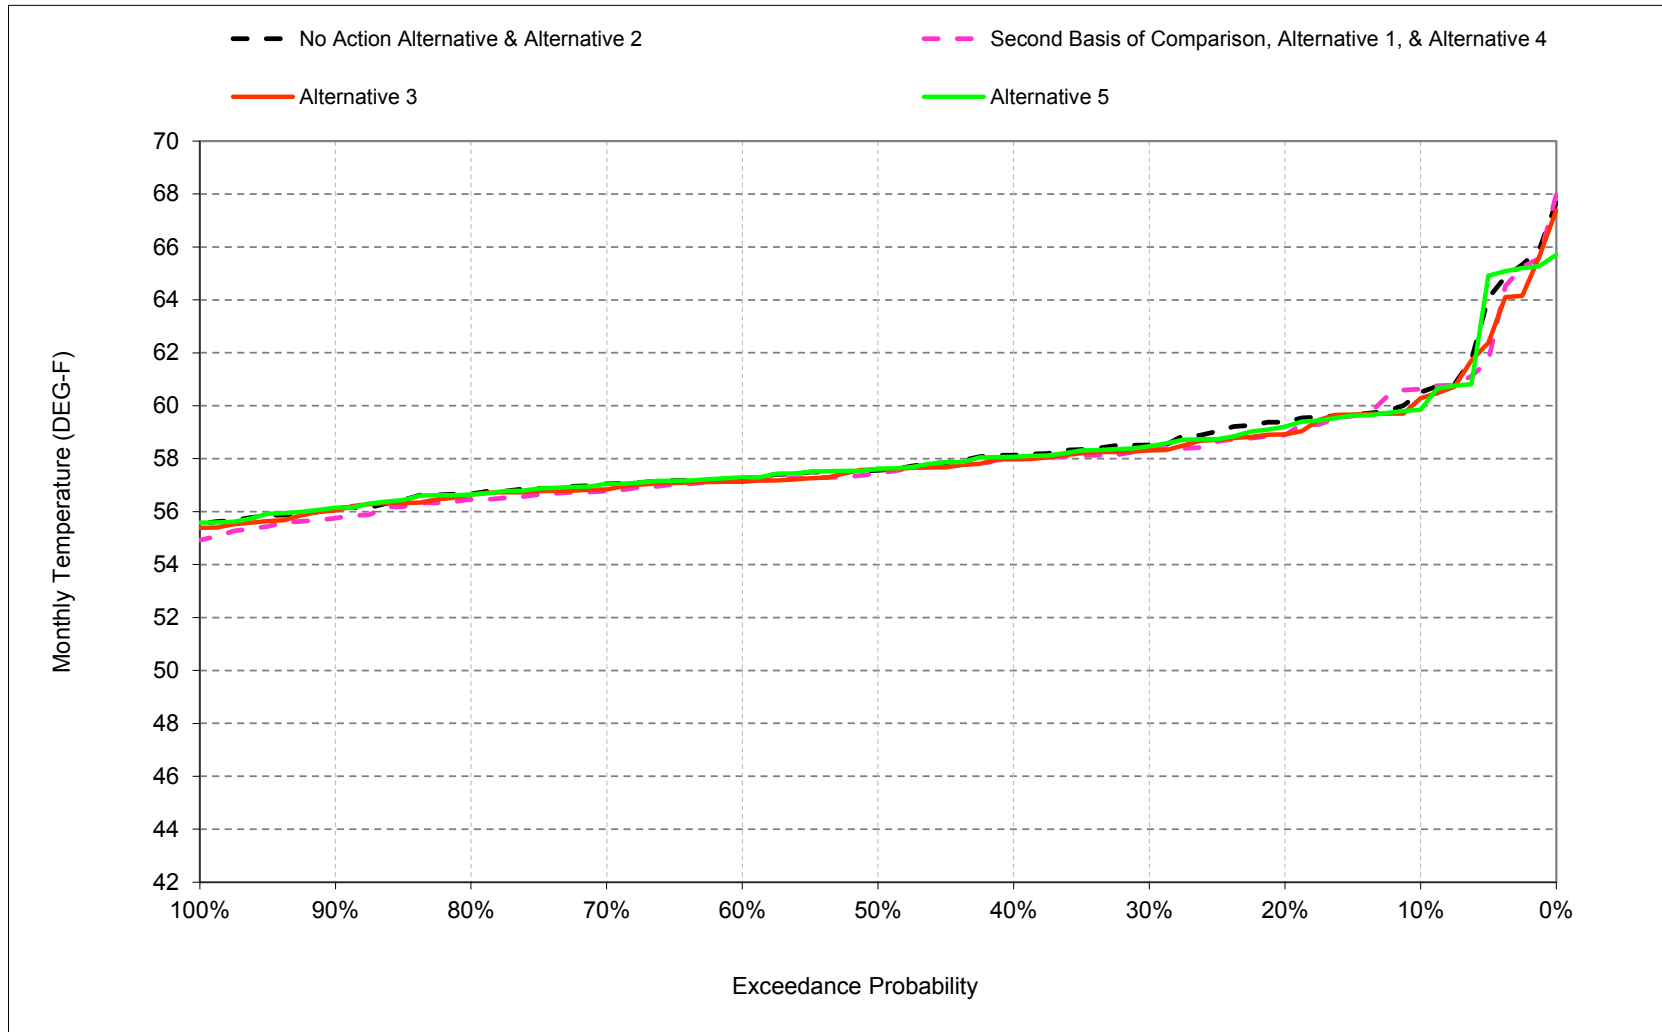

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-8-12. Sacramento River at Bend Bridge, September

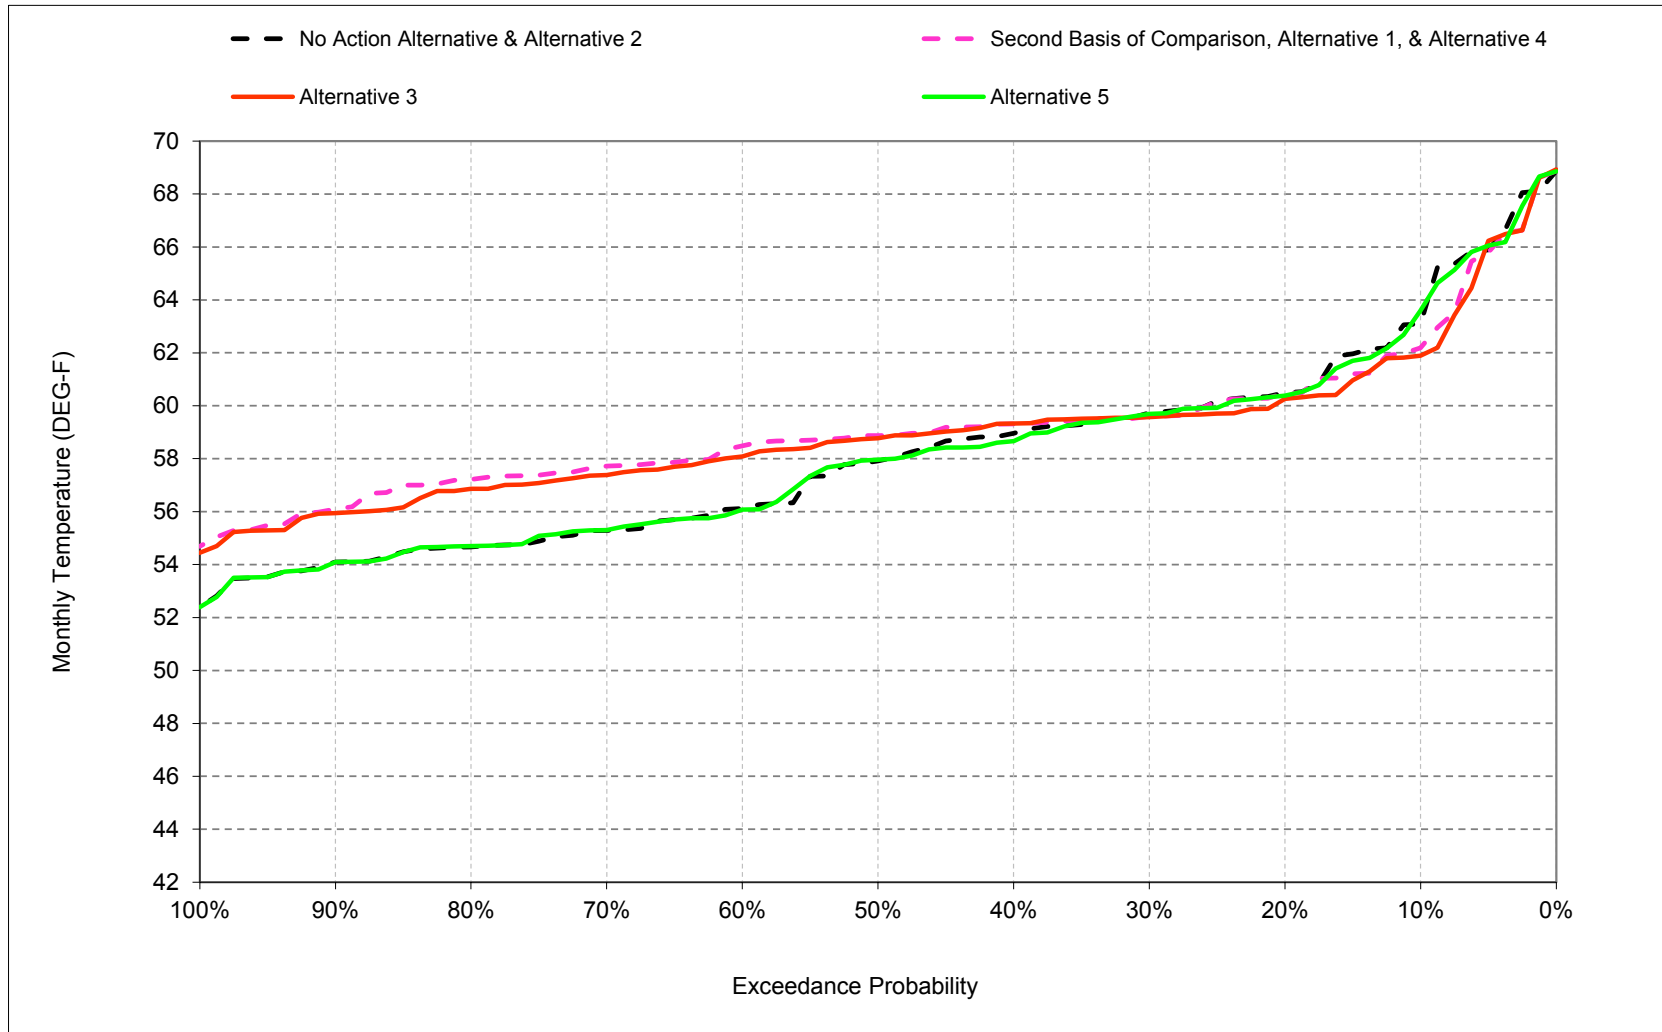

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-8-1. Sacramento River at Bend Bridge, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	56	51	48	49	52	55	58	58	59	60	63
20%	57	55	50	48	48	52	55	57	58	58	59	60
30%	57	55	49	47	48	51	54	57	57	57	59	60
40%	57	54	49	47	48	51	54	56	57	57	58	59
50%	56	54	49	47	47	50	53	56	56	56	58	58
60%	56	53	48	46	47	50	53	56	56	56	57	56
70%	56	53	48	46	47	49	53	55	55	55	57	55
80%	56	53	48	46	46	49	52	55	55	55	57	55
90%	55	52	47	46	46	48	51	54	55	55	56	54
Long Term												
Full Simulation Period ^b	57	54	49	47	47	50	53	56	56	57	58	58
Water Year Types ^c												
Wet (32%)	54	51	47	46	47	49	53	56	57	56	57	55
Above Normal (16%)	57	54	49	47	47	50	53	56	55	55	57	56
Below Normal (13%)	56	54	49	47	48	51	54	55	56	56	57	59
Dry (24%)	57	54	49	47	48	51	54	56	56	57	59	60
Critical (15%)	59	55	50	47	48	52	54	57	58	59	62	65

Alternative 1												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	60	55	51	48	49	52	55	58	58	59	61	62
20%	58	55	50	48	49	52	54	57	57	58	59	60
30%	57	54	49	47	48	51	54	56	57	57	58	60
40%	57	54	49	47	48	51	54	56	56	57	58	59
50%	56	53	49	47	47	50	53	56	56	56	57	59
60%	56	53	48	46	47	50	53	55	55	56	57	59
70%	56	53	48	46	47	49	53	55	55	56	57	58
80%	55	52	48	46	46	48	52	55	55	55	56	57
90%	55	52	47	46	46	48	51	54	54	55	56	56
Long Term												
Full Simulation Period ^b	57	53	49	47	47	50	53	56	56	57	58	59
Water Year Types ^c												
Wet (32%)	54	51	47	46	47	49	52	56	56	56	57	57
Above Normal (16%)	57	53	49	47	47	50	53	56	55	55	56	58
Below Normal (13%)	56	53	49	47	48	51	54	55	55	56	57	59
Dry (24%)	57	53	49	47	48	51	54	56	55	56	59	60
Critical (15%)	59	55	50	47	49	52	54	57	58	59	62	64

Alternative 1 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-1.0	-0.5	-0.2	-0.1	0.0	-0.1	0.2	0.0	-0.1	0.2	0.2	-0.9
0.2	0.1	-0.7	-0.3	0.0	0.0	-0.1	-0.2	0.0	-0.3	-0.2	-0.5	0.0
0.3	0.0	-0.6	0.0	0.1	0.0	0.0	-0.1	-0.1	-0.2	0.0	-0.2	-0.1
0.4	0.1	-0.5	0.0	0.0	0.0	-0.1	0.0	-0.1	-0.3	0.0	-0.2	0.4
0.5	0.2	-0.8	-0.2	0.0	0.0	-0.1	0.0	-0.1	-0.4	-0.1	-0.1	1.0
0.6	0.0	-0.4	0.0	0.0	-0.1	0.0	-0.1	-0.3	-0.4	0.2	-0.1	2.4
0.7	-0.1	-0.1	0.2	0.0	0.0	0.0	-0.2	-0.2	-0.4	0.1	-0.2	2.4
0.8	-0.1	-0.5	0.1	0.0	0.0	0.0	-0.2	-0.3	-0.4	0.1	-0.3	2.6
0.9	-0.1	-0.2	0.1	0.0	0.0	0.0	0.0	-0.1	-0.3	-0.1	-0.3	2.0
Long Term												
Full Simulation Period ^b	-0.1	-0.4	0.0	0.0	0.0	0.0	-0.1	-0.1	-0.3	0.0	-0.3	1.0
Water Year Types ^c												
Wet (32%)	0.0	-0.4	0.2	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	-0.4	2.8
Above Normal (16%)	0.0	-0.4	-0.2	0.1	0.0	-0.1	0.0	-0.2	-0.3	0.1	-0.2	2.0
Below Normal (13%)	-0.2	-0.5	-0.3	0.1	0.0	-0.3	-0.2	-0.2	-0.4	0.0	-0.5	-0.1
Dry (24%)	0.0	-0.3	-0.2	0.0	0.0	0.0	-0.2	-0.2	-0.4	-0.1	0.1	-0.1
Critical (15%)	-0.5	-0.3	0.0	0.2	0.1	0.0	0.0	0.0	-0.4	0.0	-0.4	-0.8

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-8-2. Sacramento River at Bend Bridge, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	61	56	51	48	49	52	55	58	58	59	60	63
20%	57	55	50	48	48	52	55	57	58	58	59	60
30%	57	55	49	47	48	51	54	57	57	57	59	60
40%	57	54	49	47	48	51	54	56	57	57	58	59
50%	56	54	49	47	47	50	53	56	56	56	58	58
60%	56	53	48	46	47	50	53	56	56	56	57	56
70%	56	53	48	46	47	49	53	55	55	55	57	55
80%	56	53	48	46	46	49	52	55	55	55	57	55
90%	55	52	47	46	46	48	51	54	55	55	56	54
Long Term												
Full Simulation Period ^b	57	54	49	47	47	50	53	56	56	57	58	58
Water Year Types^c												
Wet (32%)	54	51	47	46	47	49	53	56	57	56	57	55
Above Normal (16%)	57	54	49	47	47	50	53	56	55	55	57	56
Below Normal (13%)	56	54	49	47	48	51	54	55	56	56	57	59
Dry (24%)	57	54	49	47	48	51	54	56	56	57	59	60
Critical (15%)	59	55	50	47	48	52	54	57	58	59	62	65

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	60	56	51	48	49	52	55	58	58	59	60	62
20%	57	55	50	48	49	52	55	57	57	58	59	60
30%	57	54	49	47	48	51	54	57	57	57	58	60
40%	57	54	49	47	48	51	54	56	56	57	58	59
50%	56	53	49	47	47	50	53	56	56	56	58	59
60%	56	53	48	46	47	50	53	55	55	56	57	58
70%	56	53	48	46	47	49	53	55	55	56	57	57
80%	55	52	48	46	46	48	52	55	55	55	57	57
90%	55	52	47	46	46	48	51	54	54	55	56	56
Long Term												
Full Simulation Period ^b	57	53	49	47	47	50	53	56	56	57	58	59
Water Year Types^c												
Wet (32%)	54	51	47	46	47	49	52	56	56	56	57	57
Above Normal (16%)	57	53	49	47	47	50	53	56	55	55	57	58
Below Normal (13%)	56	53	49	47	48	51	54	55	55	56	57	58
Dry (24%)	57	53	49	47	48	51	54	56	55	56	59	60
Critical (15%)	59	55	50	47	48	52	54	57	58	60	62	64

Alternative 3 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
0.1	-0.6	-0.1	-0.2	-0.1	0.0	0.0	0.2	-0.1	-0.1	0.2	-0.2	-1.2
0.2	-0.1	-0.6	-0.3	0.0	0.0	0.0	-0.1	0.0	-0.3	-0.3	-0.5	-0.3
0.3	0.0	-0.6	0.0	0.1	-0.1	0.0	-0.1	0.0	-0.1	-0.1	-0.2	-0.1
0.4	0.0	-0.5	0.0	0.0	0.0	-0.1	0.0	-0.1	-0.3	-0.1	-0.2	0.4
0.5	0.1	-0.8	-0.1	0.0	0.0	-0.1	0.0	0.0	-0.3	-0.1	0.0	0.9
0.6	0.1	-0.4	0.0	0.0	-0.1	0.0	0.0	-0.3	-0.4	0.0	-0.1	2.0
0.7	0.0	-0.2	0.1	0.0	0.1	0.0	0.0	-0.2	-0.5	0.1	-0.2	2.1
0.8	-0.2	-0.5	0.1	0.0	0.0	0.0	-0.1	-0.2	-0.4	0.2	-0.1	2.2
0.9	-0.2	-0.3	0.1	0.0	0.0	0.0	0.0	-0.2	-0.1	0.1	0.0	1.8
Long Term												
Full Simulation Period ^b	-0.1	-0.4	0.0	0.0	0.0	0.0	0.0	-0.1	-0.3	0.0	-0.2	0.8
Water Year Types^c												
Wet (32%)	-0.1	-0.4	0.2	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	-0.2	2.6
Above Normal (16%)	0.0	-0.4	-0.2	0.0	0.0	-0.1	0.0	-0.3	-0.2	0.1	0.0	2.0
Below Normal (13%)	-0.2	-0.5	-0.3	0.1	0.0	-0.2	-0.1	-0.2	-0.3	-0.1	-0.1	-1.0
Dry (24%)	-0.1	-0.4	-0.1	0.0	0.0	0.0	-0.1	-0.1	-0.4	-0.1	-0.2	-0.2
Critical (15%)	-0.4	-0.2	0.0	0.1	0.1	0.0	0.1	0.0	-0.3	0.1	-0.5	-0.9

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-8-3. Sacramento River at Bend Bridge, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	56	51	48	49	52	55	58	58	59	60	63
20%	57	55	50	48	48	52	55	57	58	58	59	60
30%	57	55	49	47	48	51	54	57	57	57	59	60
40%	57	54	49	47	48	51	54	56	57	57	58	59
50%	56	54	49	47	47	50	53	56	56	56	58	58
60%	56	53	48	46	47	50	53	56	56	56	57	56
70%	56	53	48	46	47	49	53	55	55	55	57	55
80%	56	53	48	46	46	49	52	55	55	55	57	55
90%	55	52	47	46	46	48	51	54	55	55	56	54
Long Term												
Full Simulation Period ^b	57	54	49	47	47	50	53	56	56	57	58	58
Water Year Types ^c												
Wet (32%)	54	51	47	46	47	49	53	56	57	56	57	55
Above Normal (16%)	57	54	49	47	47	50	53	56	55	55	57	56
Below Normal (13%)	56	54	49	47	48	51	54	55	56	56	57	59
Dry (24%)	57	54	49	47	48	51	54	56	56	57	59	60
Critical (15%)	59	55	50	47	48	52	54	57	58	59	62	65

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	56	51	48	49	52	55	58	58	59	60	64
20%	57	55	50	48	48	52	55	57	57	58	59	60
30%	57	55	49	47	48	51	54	57	57	57	58	60
40%	57	54	49	47	48	51	54	56	56	57	58	59
50%	56	54	49	47	47	50	53	56	56	56	58	58
60%	56	53	48	46	47	50	53	56	56	56	57	56
70%	56	53	48	46	47	49	53	55	55	55	57	55
80%	55	53	48	46	46	49	52	55	55	55	57	55
90%	55	52	47	46	46	48	51	54	55	55	56	54
Long Term												
Full Simulation Period ^b	57	54	49	47	47	50	53	56	56	56	58	58
Water Year Types ^c												
Wet (32%)	54	51	47	46	47	49	53	56	57	56	57	55
Above Normal (16%)	57	54	49	47	47	50	53	56	55	55	57	56
Below Normal (13%)	56	54	49	47	48	51	54	55	56	56	57	59
Dry (24%)	57	54	49	47	48	51	54	56	56	57	59	60
Critical (15%)	59	55	50	47	48	52	54	57	58	59	62	65

Alternative 5 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.6	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.6	0.4
0.2	0.0	-0.1	0.1	0.0	0.0	0.0	-0.1	0.1	-0.1	-0.1	-0.2	-0.1
0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-0.1	0.0
0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	-0.1	0.0	-0.1	-0.3
0.5	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.2	0.0	0.1
0.6	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-0.1	0.0	-0.1
0.7	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	-0.1	0.0	0.1
0.8	-0.1	0.0	0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0
0.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.1	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	-0.1	-0.1	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.1
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.2	-0.1
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.0	-0.1	-0.3	-0.2
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.2	0.1	-0.2	-0.2	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-8-4. Sacramento River at Bend Bridge, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	60	55	51	48	49	52	55	58	58	59	61	62
20%	58	55	50	48	49	52	54	57	57	58	59	60
30%	57	54	49	47	48	51	54	56	57	57	58	60
40%	57	54	49	47	48	51	54	56	56	57	58	59
50%	56	53	49	47	47	50	53	56	56	56	57	59
60%	56	53	48	46	47	50	53	55	55	56	57	59
70%	56	53	48	46	47	49	53	55	55	56	57	58
80%	55	52	48	46	46	48	52	55	55	55	56	57
90%	55	52	47	46	46	48	51	54	54	55	56	56
Long Term												
Full Simulation Period ^b	57	53	49	47	47	50	53	56	56	57	58	59
Water Year Types^c												
Wet (32%)	54	51	47	46	47	49	52	56	56	56	57	57
Above Normal (16%)	57	53	49	47	47	50	53	56	55	55	56	58
Below Normal (13%)	56	53	49	47	48	51	54	55	55	56	57	59
Dry (24%)	57	53	49	47	48	51	54	56	55	56	59	60
Critical (15%)	59	55	50	47	49	52	54	57	58	59	62	64

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	61	56	51	48	49	52	55	58	58	59	60	63
20%	57	55	50	48	48	52	55	57	58	58	59	60
30%	57	55	49	47	48	51	54	57	57	57	59	60
40%	57	54	49	47	48	51	54	56	57	57	58	59
50%	56	54	49	47	47	50	53	56	56	56	58	58
60%	56	53	48	46	47	50	53	56	56	56	57	56
70%	56	53	48	46	47	49	53	55	55	55	57	55
80%	56	53	48	46	46	49	52	55	55	55	57	55
90%	55	52	47	46	46	48	51	54	55	55	56	54
Long Term												
Full Simulation Period ^b	57	54	49	47	47	50	53	56	56	57	58	58
Water Year Types^c												
Wet (32%)	54	51	47	46	47	49	53	56	57	56	57	55
Above Normal (16%)	57	54	49	47	47	50	53	56	55	55	57	56
Below Normal (13%)	56	54	49	47	48	51	54	55	56	56	57	59
Dry (24%)	57	54	49	47	48	51	54	56	56	57	59	60
Critical (15%)	59	55	50	47	48	52	54	57	58	59	62	65

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
0.1	1.0	0.5	0.2	0.1	0.0	0.1	-0.2	0.0	0.1	-0.2	-0.2	0.9
0.2	-0.1	0.7	0.3	0.0	0.0	0.1	0.2	0.0	0.3	0.2	0.5	0.0
0.3	0.0	0.6	0.0	-0.1	0.0	0.0	0.1	0.1	0.2	0.0	0.2	0.1
0.4	-0.1	0.5	0.0	0.0	0.0	0.1	0.0	0.1	0.3	0.0	0.2	-0.4
0.5	-0.2	0.8	0.2	0.0	0.0	0.1	0.0	0.1	0.4	0.1	0.1	-1.0
0.6	0.0	0.4	0.0	0.0	0.1	0.0	0.1	0.3	0.4	-0.2	0.1	-2.4
0.7	0.1	0.1	-0.2	0.0	0.0	0.0	0.2	0.2	0.4	-0.1	0.2	-2.4
0.8	0.1	0.5	-0.1	0.0	0.0	0.0	0.2	0.3	0.4	-0.1	0.3	-2.6
0.9	0.1	0.2	-0.1	0.0	0.0	0.0	0.0	0.1	0.3	0.1	0.3	-2.0
Long Term												
Full Simulation Period ^b	0.1	0.4	0.0	0.0	0.0	0.0	0.1	0.1	0.3	0.0	0.3	-1.0
Water Year Types^c												
Wet (32%)	0.0	0.4	-0.2	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.4	-2.8
Above Normal (16%)	0.0	0.4	0.2	-0.1	0.0	0.1	0.0	0.2	0.3	-0.1	0.2	-2.0
Below Normal (13%)	0.2	0.5	0.3	-0.1	0.0	0.3	0.2	0.2	0.4	0.0	0.5	0.1
Dry (24%)	0.0	0.3	0.2	0.0	0.0	0.0	0.2	0.2	0.4	0.1	-0.1	0.1
Critical (15%)	0.5	0.3	0.0	-0.2	-0.1	0.0	0.0	0.0	0.4	0.0	0.4	0.8

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-8-5. Sacramento River at Bend Bridge, Monthly Temperature

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	60	55	51	48	49	52	55	58	58	59	61	62
20%	58	55	50	48	49	52	54	57	57	58	59	60
30%	57	54	49	47	48	51	54	56	57	57	58	60
40%	57	54	49	47	48	51	54	56	56	57	58	59
50%	56	53	49	47	47	50	53	56	56	56	57	59
60%	56	53	48	46	47	50	53	55	55	56	57	59
70%	56	53	48	46	47	49	53	55	55	56	57	58
80%	55	52	48	46	46	48	52	55	55	55	56	57
90%	55	52	47	46	46	48	51	54	54	55	56	56
Long Term												
Full Simulation Period ^b	57	53	49	47	47	50	53	56	56	57	58	59
Water Year Types ^c												
Wet (32%)	54	51	47	46	47	49	52	56	56	56	57	57
Above Normal (16%)	57	53	49	47	47	50	53	56	55	55	56	58
Below Normal (13%)	56	53	49	47	48	51	54	55	55	56	57	59
Dry (24%)	57	53	49	47	48	51	54	56	55	56	59	60
Critical (15%)	59	55	50	47	49	52	54	57	58	59	62	64

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 3												
Probability of Exceedance ^a												
10%	60	56	51	48	49	52	55	58	58	59	60	62
20%	57	55	50	48	49	52	55	57	57	58	59	60
30%	57	54	49	47	48	51	54	57	57	57	58	60
40%	57	54	49	47	48	51	54	56	56	57	58	59
50%	56	53	49	47	47	50	53	56	56	56	58	59
60%	56	53	48	46	47	50	53	55	55	56	57	58
70%	56	53	48	46	47	49	53	55	55	56	57	57
80%	55	52	48	46	46	48	52	55	55	55	57	57
90%	55	52	47	46	46	48	51	54	54	55	56	56
Long Term												
Full Simulation Period ^b	57	53	49	47	47	50	53	56	56	57	58	59
Water Year Types ^c												
Wet (32%)	54	51	47	46	47	49	52	56	56	56	57	57
Above Normal (16%)	57	53	49	47	47	50	53	56	55	55	57	58
Below Normal (13%)	56	53	49	47	48	51	54	55	55	56	57	58
Dry (24%)	57	53	49	47	48	51	54	56	55	56	59	60
Critical (15%)	59	55	50	47	48	52	54	57	58	60	62	64

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 3 minus Second Basis of Comparison												
Probability of Exceedance ^a												
0.1	0.4	0.4	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.0	-0.4	-0.3
0.2	-0.2	0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-0.1	0.0	-0.3
0.3	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	-0.1	0.0	0.0
0.4	0.0	0.0	0.1	0.0	0.1	0.0	0.0	0.0	0.0	-0.1	0.0	0.0
0.5	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.2	-0.1
0.6	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-0.1	0.0	-0.4
0.7	0.1	0.0	-0.1	0.0	0.1	0.0	0.2	0.0	0.0	0.0	0.1	-0.3
0.8	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.1	0.2	-0.4
0.9	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	-0.1	0.3	0.2	0.3	-0.2
Long Term												
Full Simulation Period ^b	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.2
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.2	-0.2
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.2	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.1	0.0	0.3	-0.9
Dry (24%)	-0.2	-0.1	0.1	0.0	0.0	0.0	0.1	0.0	0.0	0.0	-0.3	-0.1
Critical (15%)	0.0	0.1	0.0	-0.1	-0.1	0.0	0.0	0.0	0.1	0.1	-0.2	-0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-8-6. Sacramento River at Bend Bridge, Monthly Temperature

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	60	55	51	48	49	52	55	58	58	59	61	62
20%	58	55	50	48	49	52	54	57	57	58	59	60
30%	57	54	49	47	48	51	54	56	57	57	58	60
40%	57	54	49	47	48	51	54	56	56	57	58	59
50%	56	53	49	47	47	50	53	56	56	56	57	59
60%	56	53	48	46	47	50	53	55	55	56	57	59
70%	56	53	48	46	47	49	53	55	55	56	57	58
80%	55	52	48	46	46	48	52	55	55	55	56	57
90%	55	52	47	46	46	48	51	54	54	55	56	56
Long Term												
Full Simulation Period ^b	57	53	49	47	47	50	53	56	56	57	58	59
Water Year Types ^c												
Wet (32%)	54	51	47	46	47	49	52	56	56	56	57	57
Above Normal (16%)	57	53	49	47	47	50	53	56	55	55	56	58
Below Normal (13%)	56	53	49	47	48	51	54	55	55	56	57	59
Dry (24%)	57	53	49	47	48	51	54	56	55	56	59	60
Critical (15%)	59	55	50	47	49	52	54	57	58	59	62	64

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 5												
Probability of Exceedance ^a												
10%	61	56	51	48	49	52	55	58	58	59	60	64
20%	57	55	50	48	48	52	55	57	57	58	59	60
30%	57	55	49	47	48	51	54	57	57	57	58	60
40%	57	54	49	47	48	51	54	56	56	57	58	59
50%	56	54	49	47	47	50	53	56	56	56	58	58
60%	56	53	48	46	47	50	53	56	56	56	57	56
70%	56	53	48	46	47	49	53	55	55	55	57	55
80%	55	53	48	46	46	49	52	55	55	55	57	55
90%	55	52	47	46	46	48	51	54	55	55	56	54
Long Term												
Full Simulation Period ^b	57	54	49	47	47	50	53	56	56	56	58	58
Water Year Types ^c												
Wet (32%)	54	51	47	46	47	49	53	56	57	56	57	55
Above Normal (16%)	57	54	49	47	47	50	53	56	55	55	57	56
Below Normal (13%)	56	54	49	47	48	51	54	55	56	56	57	59
Dry (24%)	57	54	49	47	48	51	54	56	56	57	59	60
Critical (15%)	59	55	50	47	48	52	54	57	58	59	62	65

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 5 minus Second Basis of Comparison												
Probability of Exceedance ^a												
0.1	1.6	0.4	0.1	0.1	0.0	0.1	-0.2	0.0	0.1	-0.3	-0.8	1.3
0.2	-0.1	0.6	0.4	0.0	0.0	0.0	0.1	0.1	0.2	0.1	0.3	-0.1
0.3	0.0	0.6	0.0	-0.1	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1
0.4	-0.1	0.5	0.0	-0.1	0.0	0.1	0.0	0.2	0.2	-0.1	0.1	-0.7
0.5	-0.2	0.7	0.1	0.0	0.0	0.1	0.0	0.1	0.5	0.0	0.2	-0.9
0.6	-0.1	0.4	0.0	0.0	0.1	0.0	0.1	0.3	0.4	-0.2	0.1	-2.5
0.7	0.0	0.2	-0.2	0.0	0.0	0.0	0.3	0.3	0.4	-0.1	0.2	-2.4
0.8	0.0	0.5	0.0	0.0	0.0	0.0	0.2	0.4	0.4	-0.1	0.2	-2.5
0.9	0.1	0.2	-0.1	0.0	0.0	0.0	0.0	0.2	0.4	0.1	0.4	-2.0
Long Term												
Full Simulation Period ^b	0.1	0.4	0.0	0.0	0.0	0.0	0.1	0.2	0.3	0.0	0.2	-1.1
Water Year Types ^c												
Wet (32%)	0.1	0.4	-0.2	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.4	-2.8
Above Normal (16%)	0.0	0.3	0.2	-0.1	0.0	0.1	0.0	0.3	0.3	-0.1	0.2	-2.0
Below Normal (13%)	0.2	0.5	0.3	-0.1	0.0	0.2	0.2	0.2	0.4	0.0	0.6	0.0
Dry (24%)	0.0	0.3	0.1	0.1	0.0	0.0	0.2	0.4	0.4	0.1	-0.3	0.0
Critical (15%)	0.5	0.3	0.0	-0.2	-0.2	0.0	0.1	0.2	0.5	-0.2	0.1	0.8

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


B.9. Sacramento River at Red Bluff Temperature

Figure B-9-1. Sacramento River at Red Bluff, October

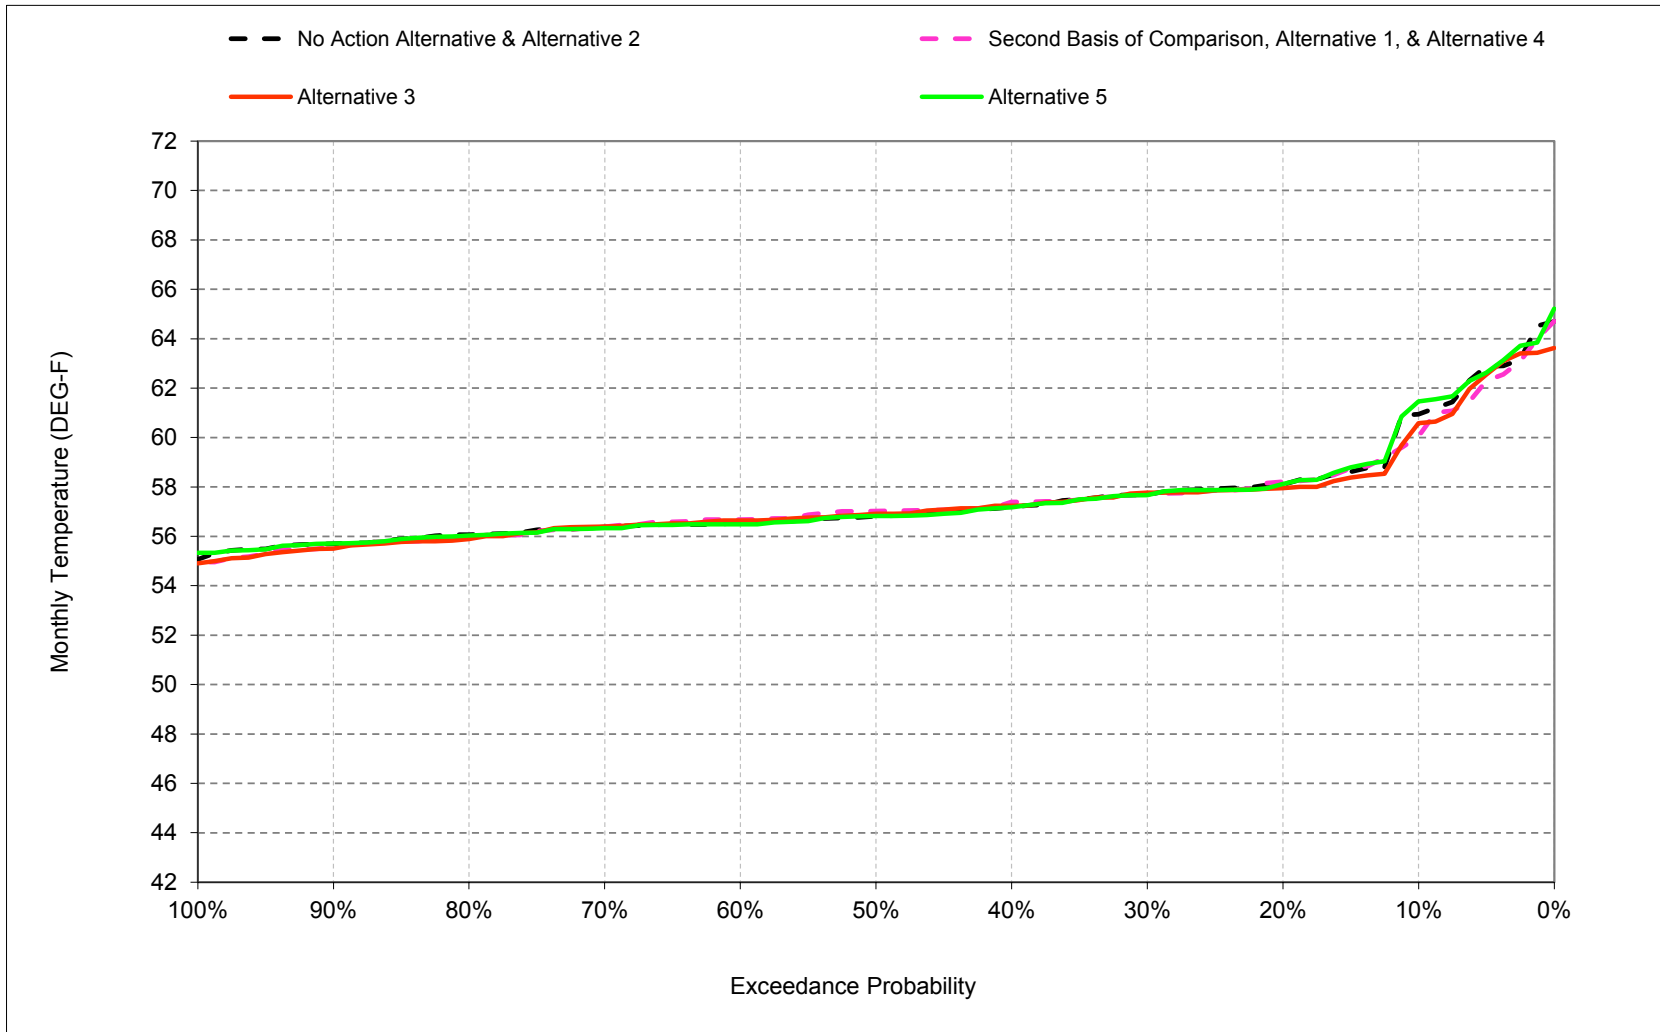


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-9-2. Sacramento River at Red Bluff, November

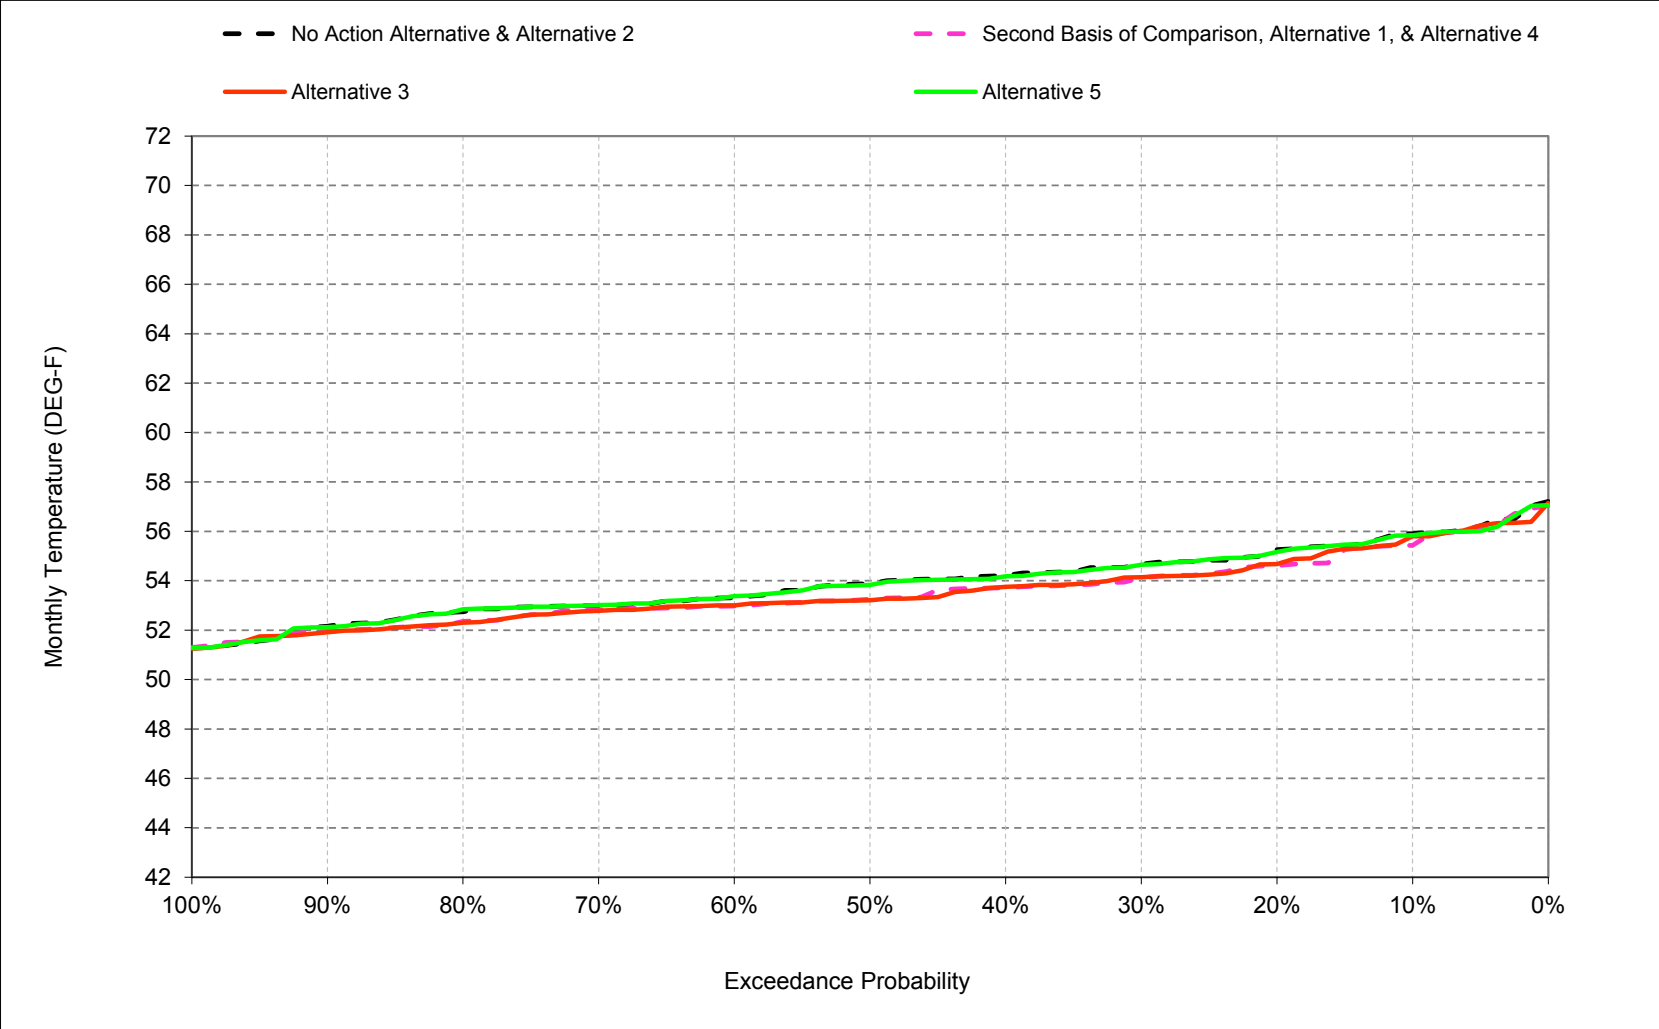


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-9-3. Sacramento River at Red Bluff, December

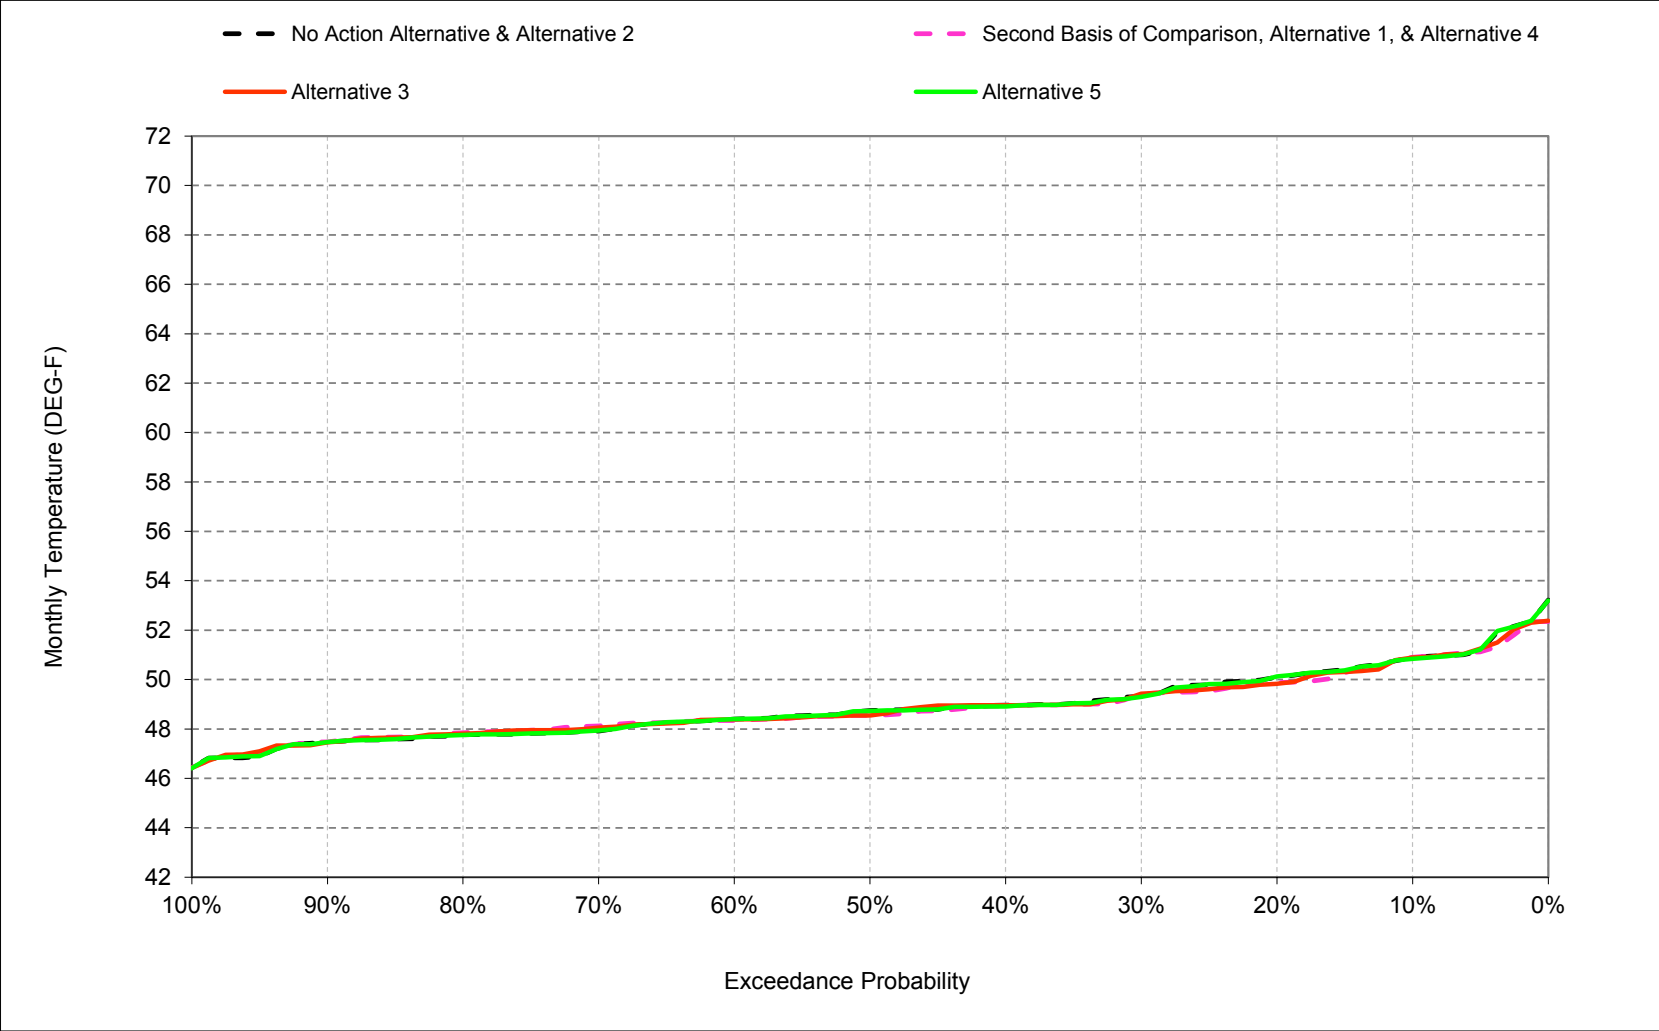


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-9-4. Sacramento River at Red Bluff, January

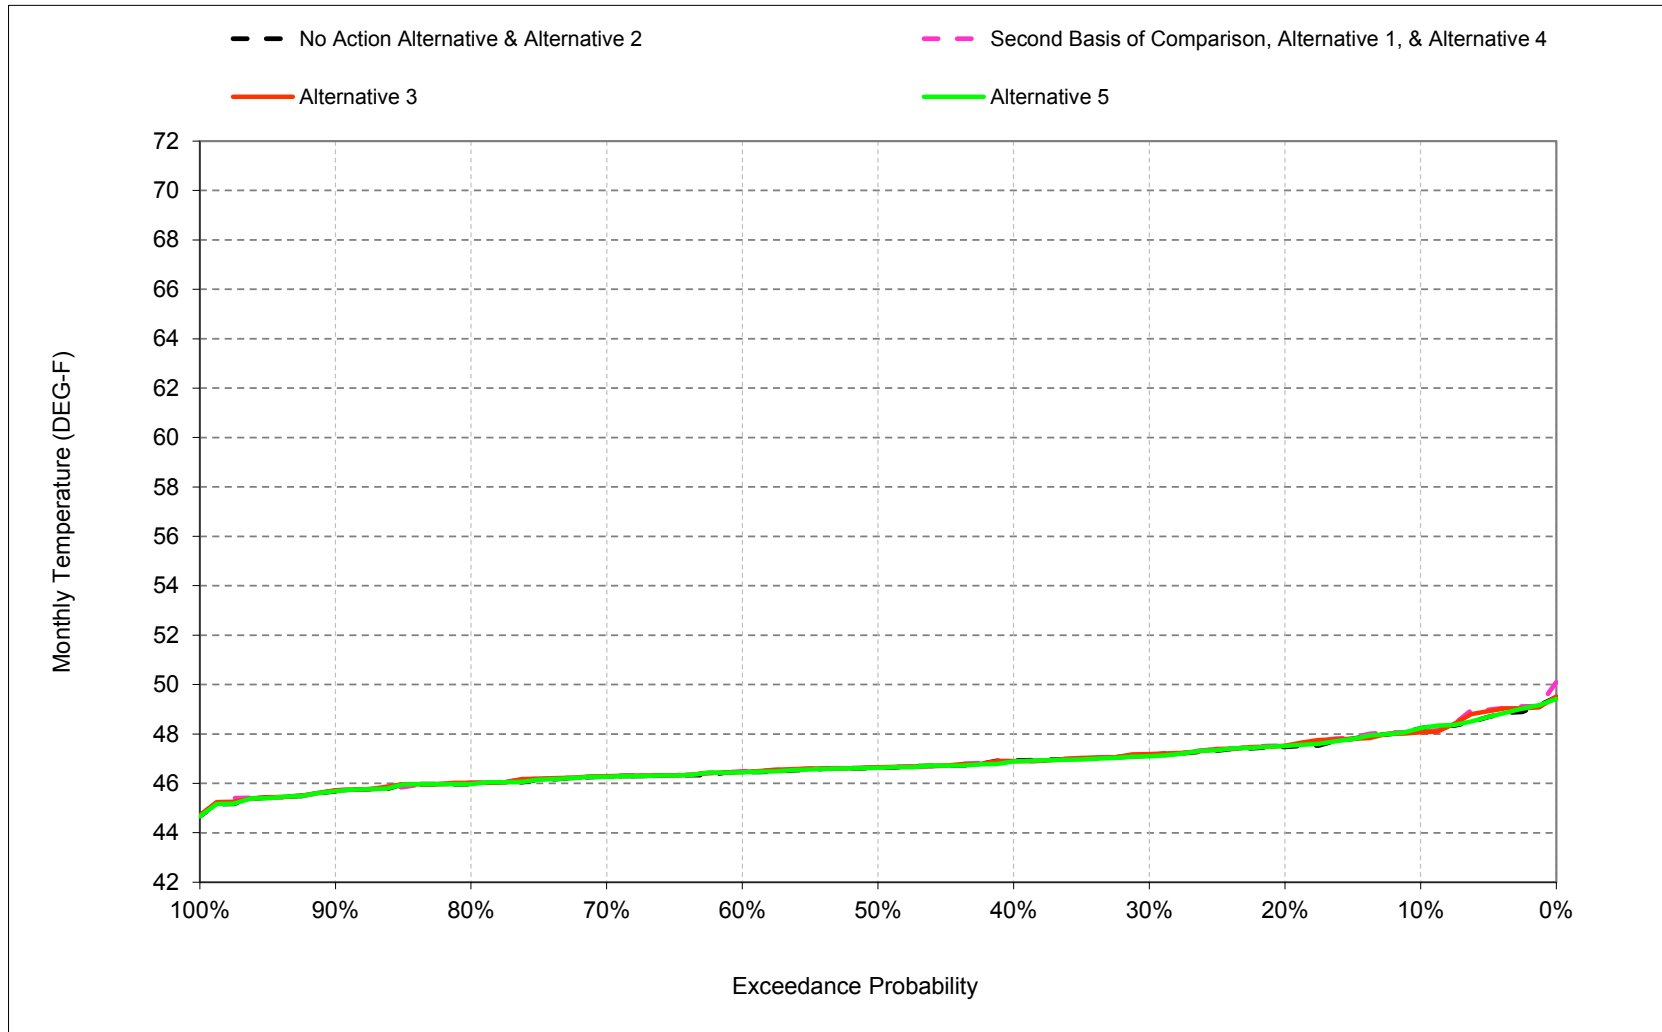


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-9-5. Sacramento River at Red Bluff, February

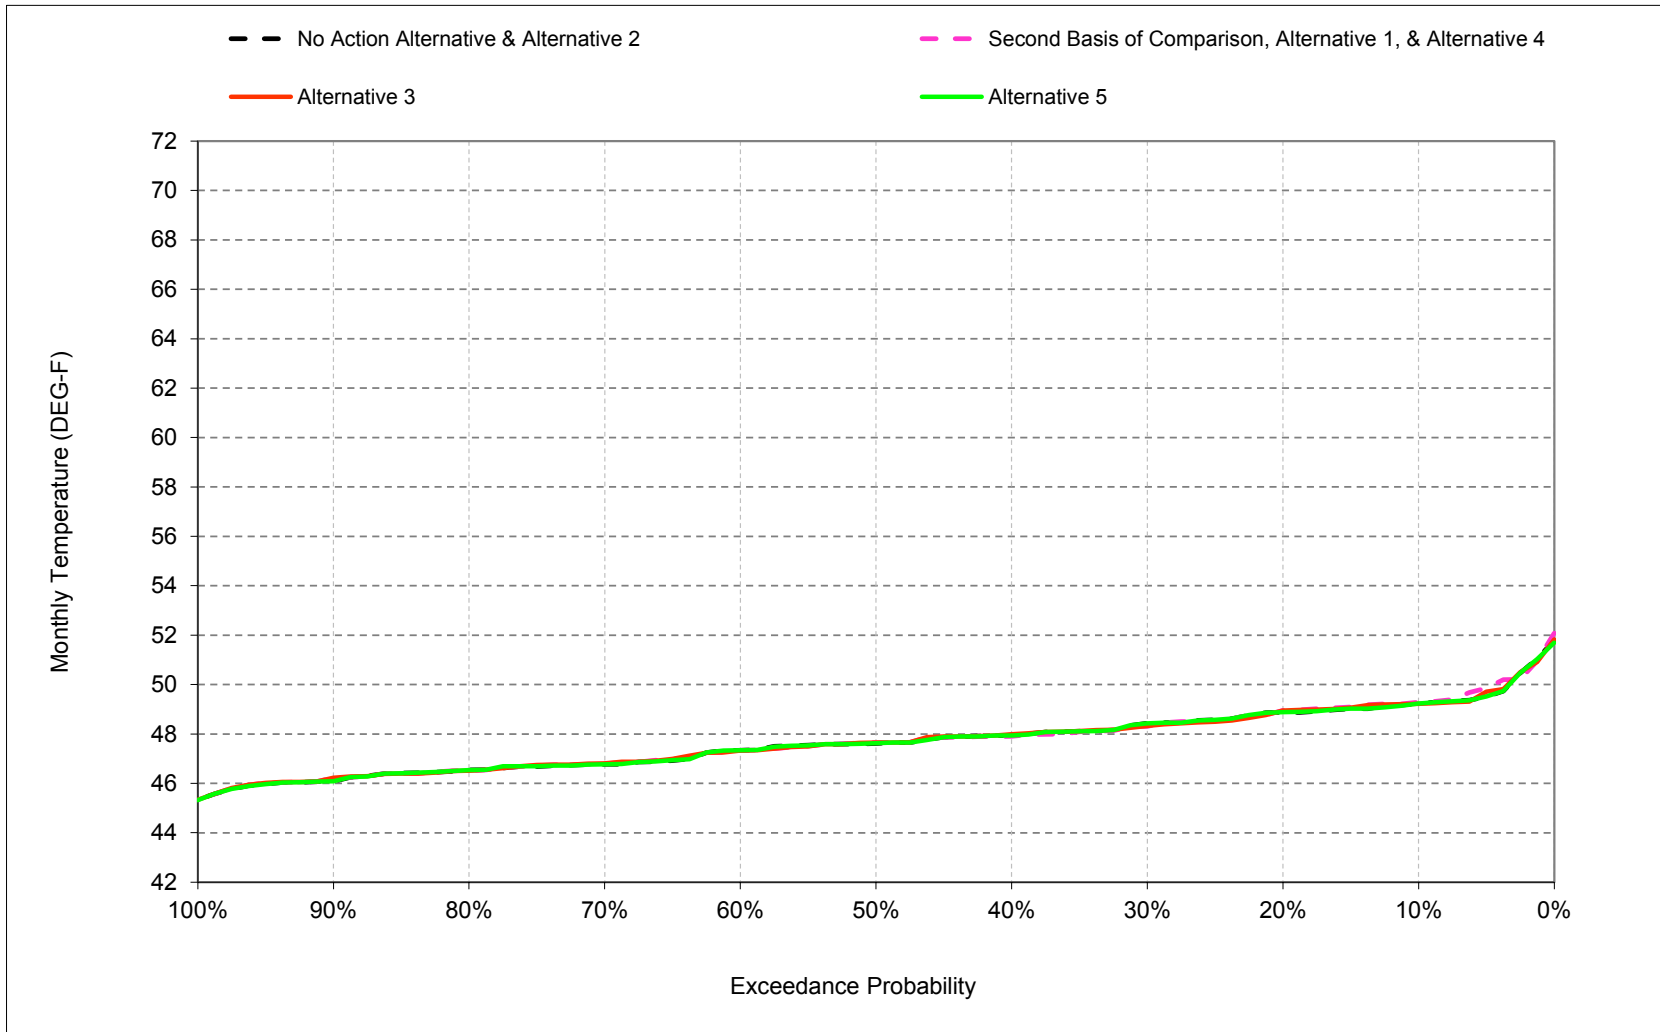


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-9-6. Sacramento River at Red Bluff, March

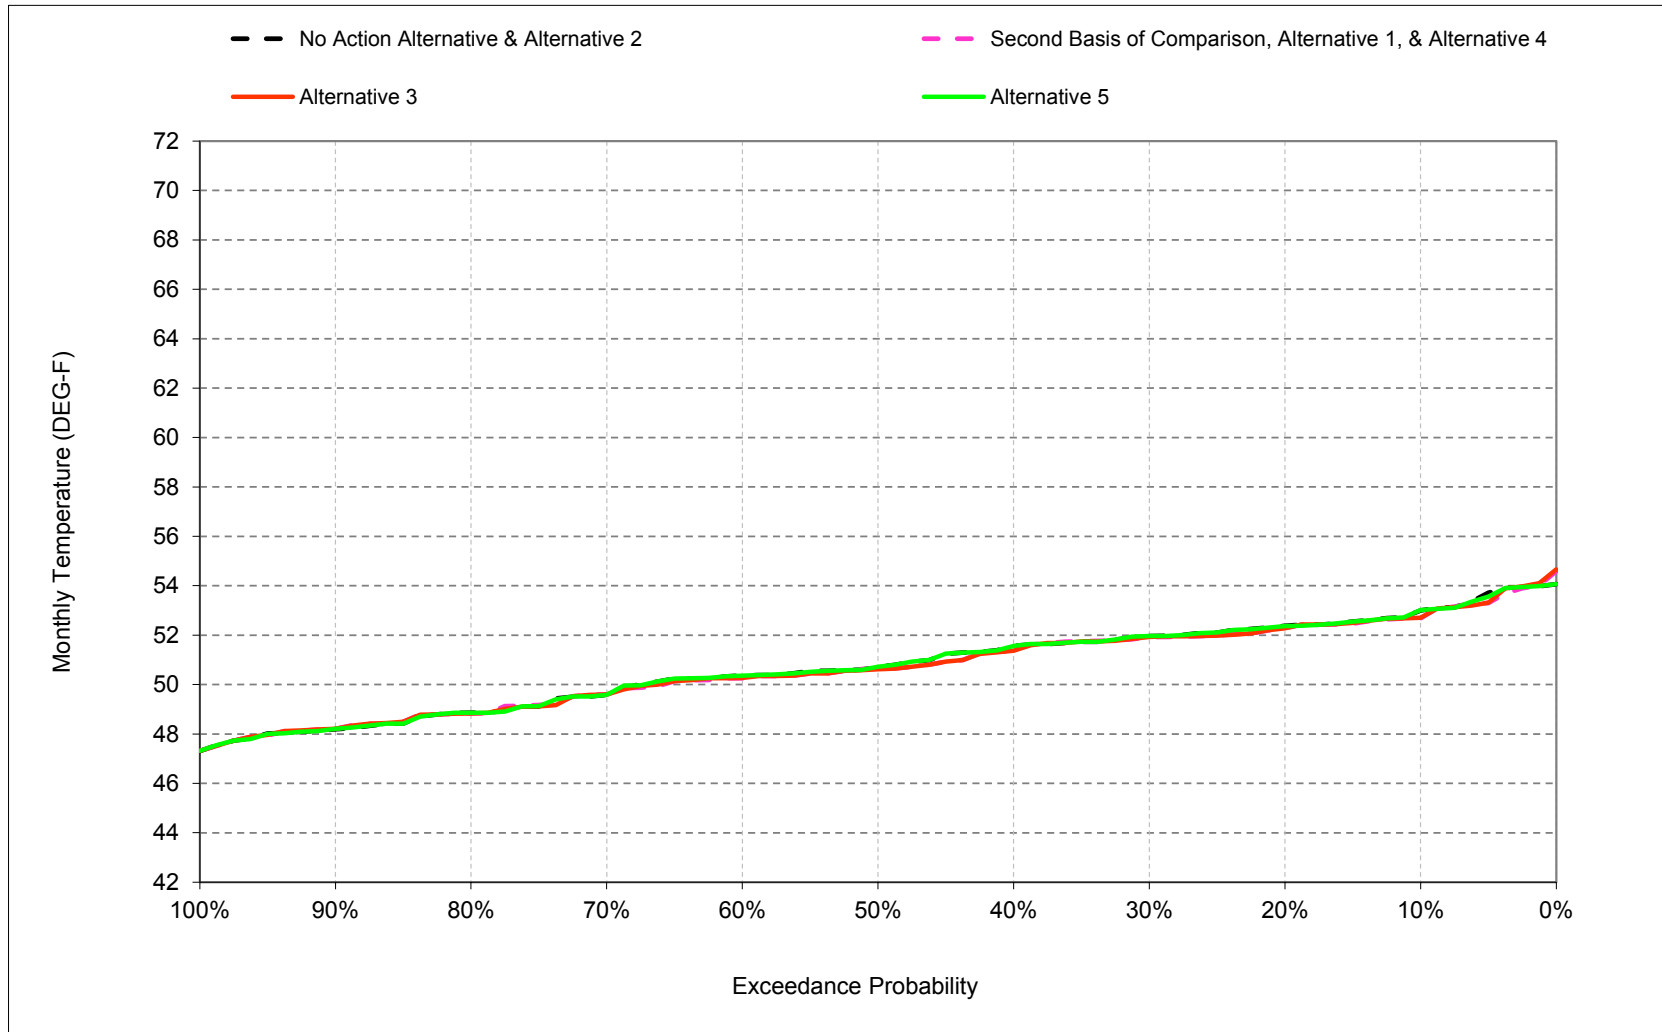


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-9-7. Sacramento River at Red Bluff, April

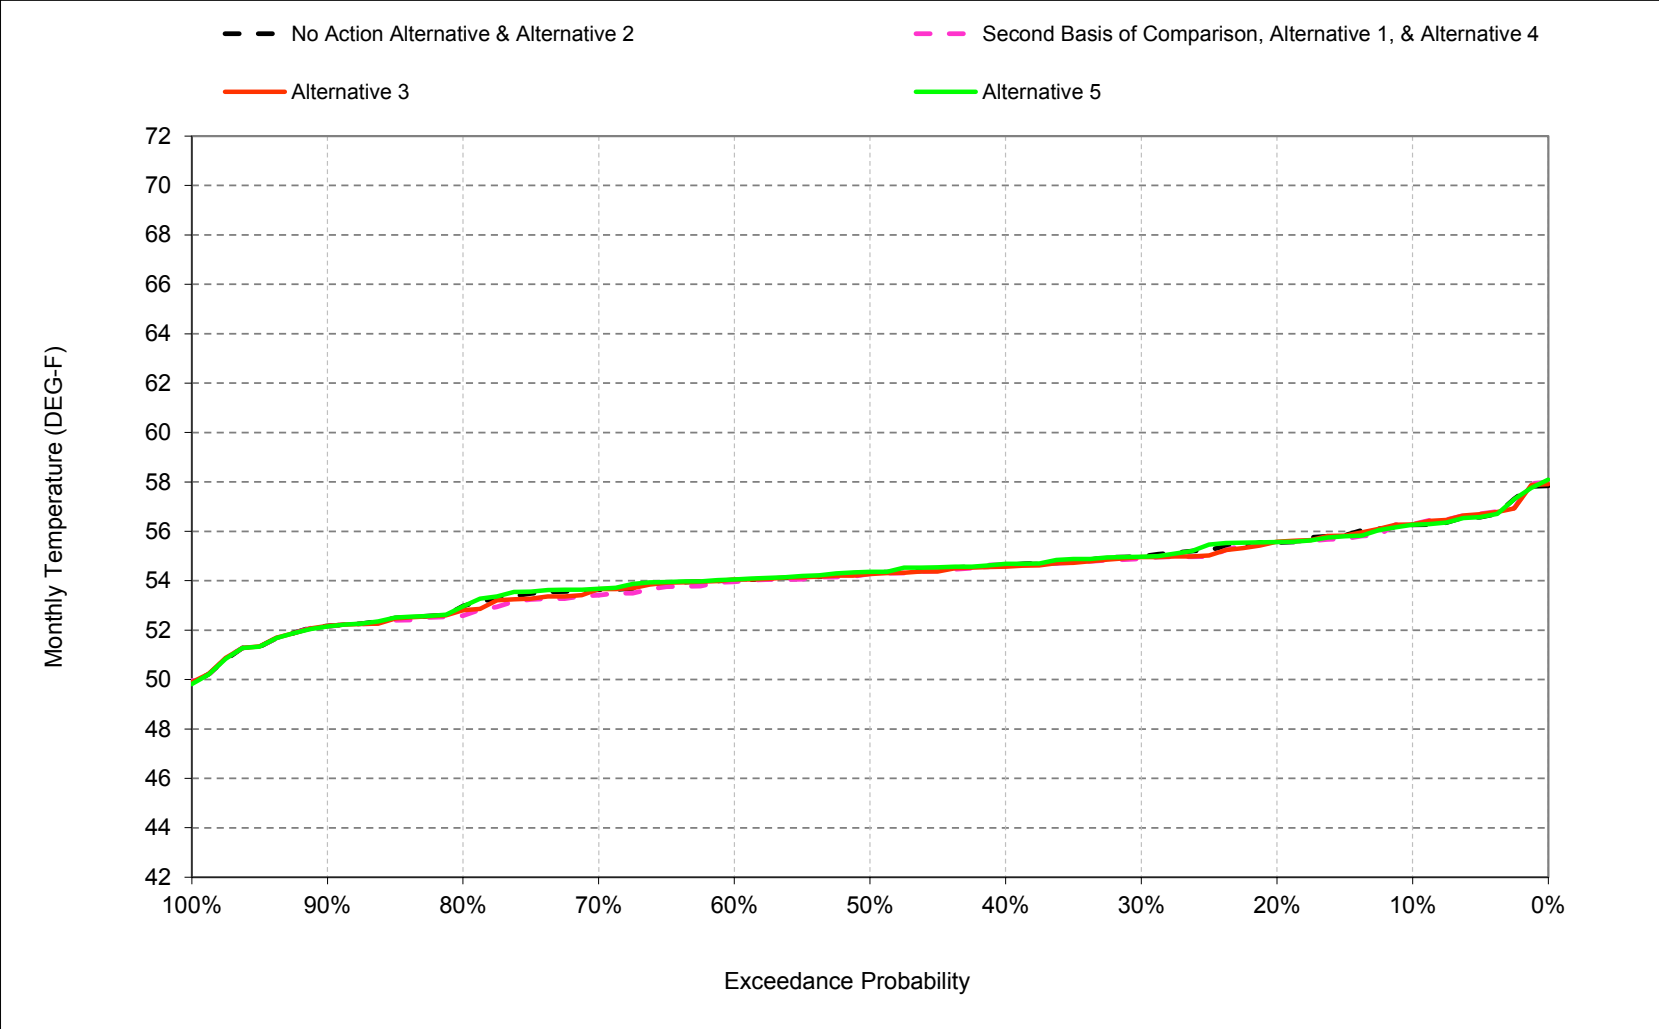


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-9-8. Sacramento River at Red Bluff, May

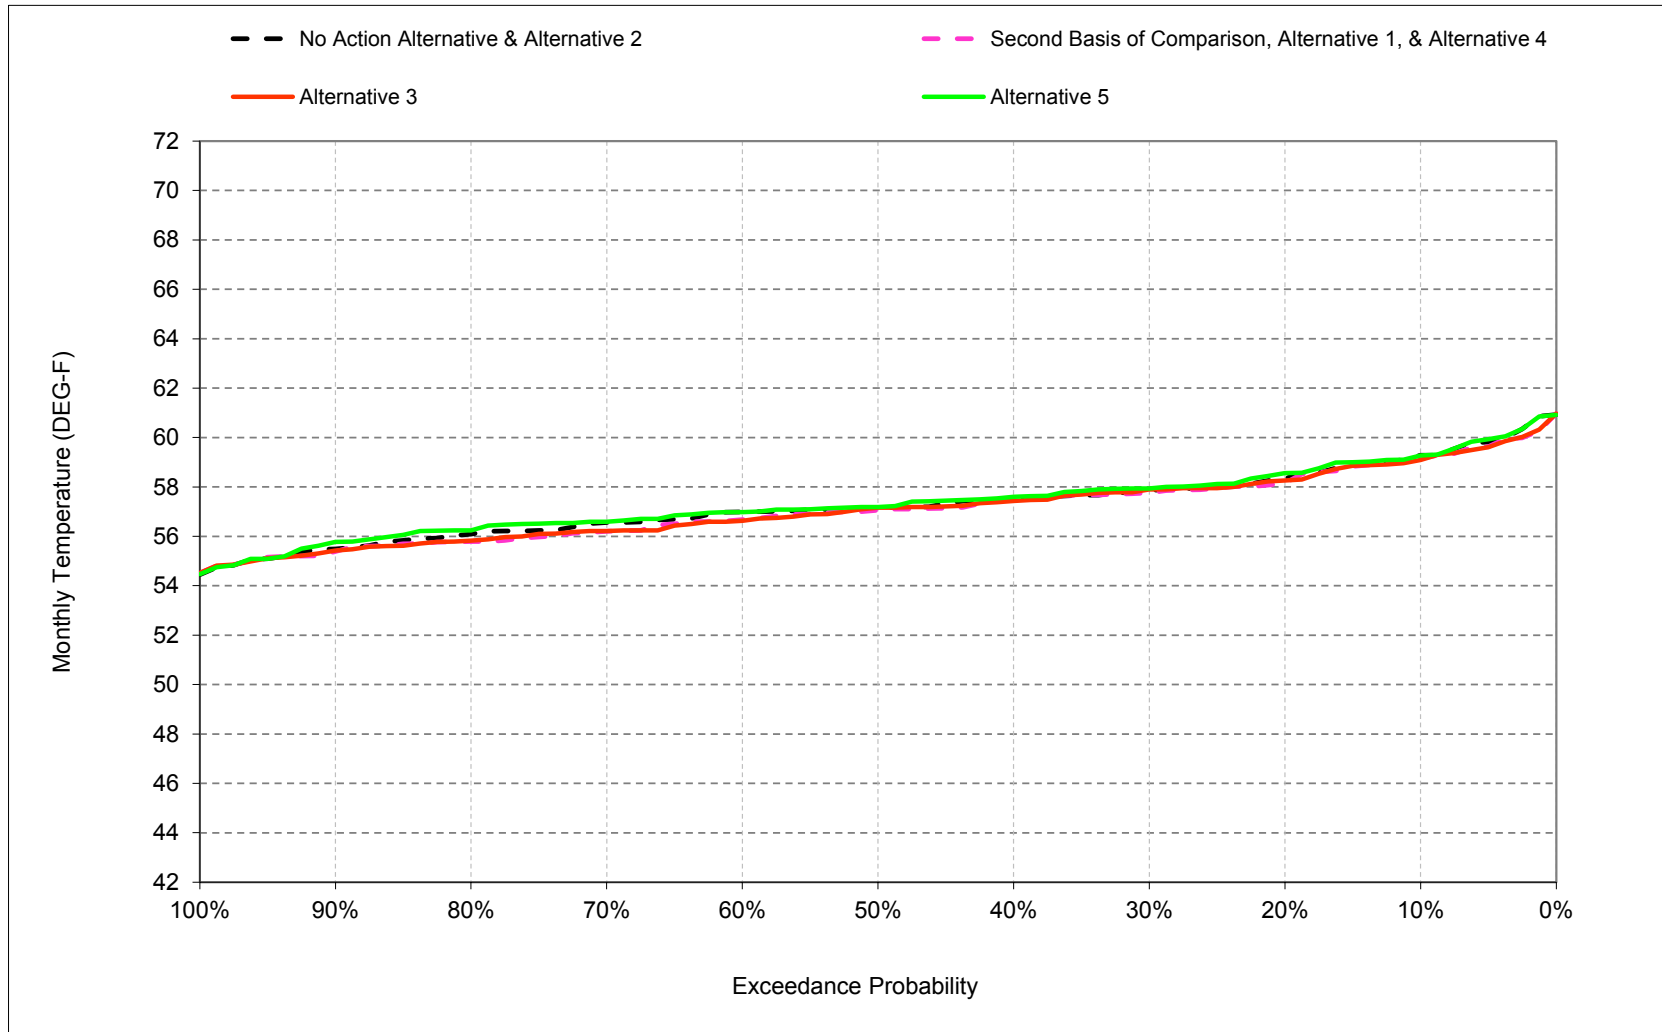


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-9-9. Sacramento River at Red Bluff, June

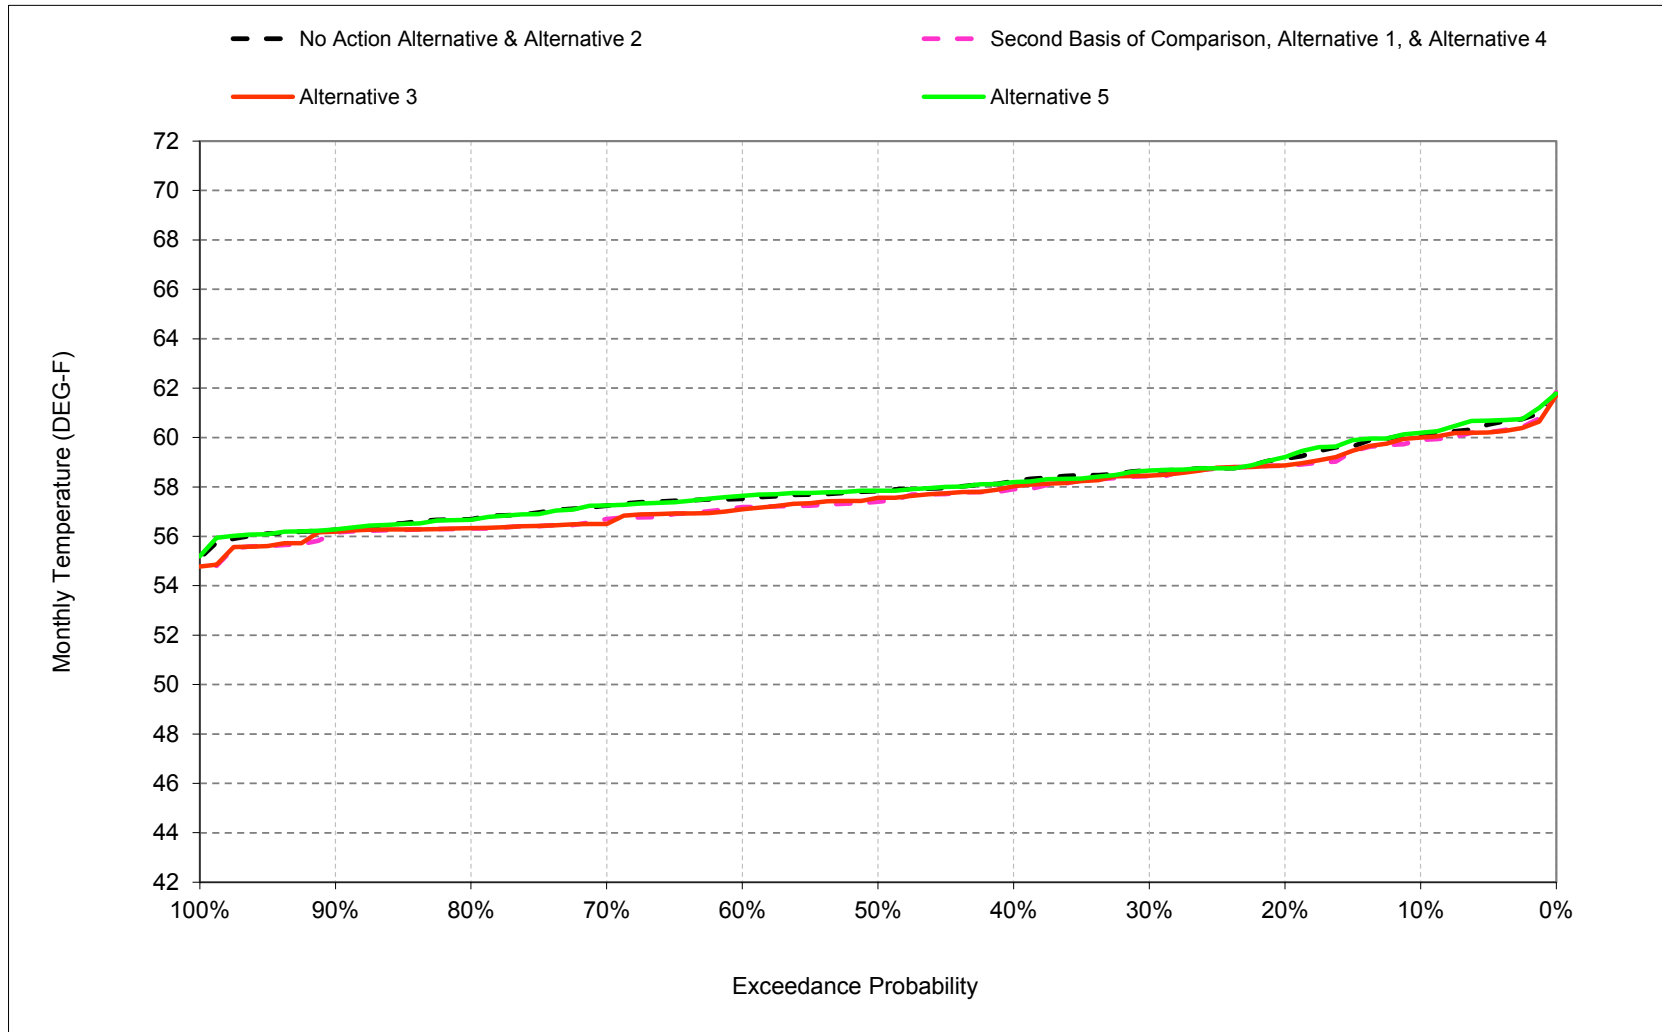


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-9-10. Sacramento River at Red Bluff, July

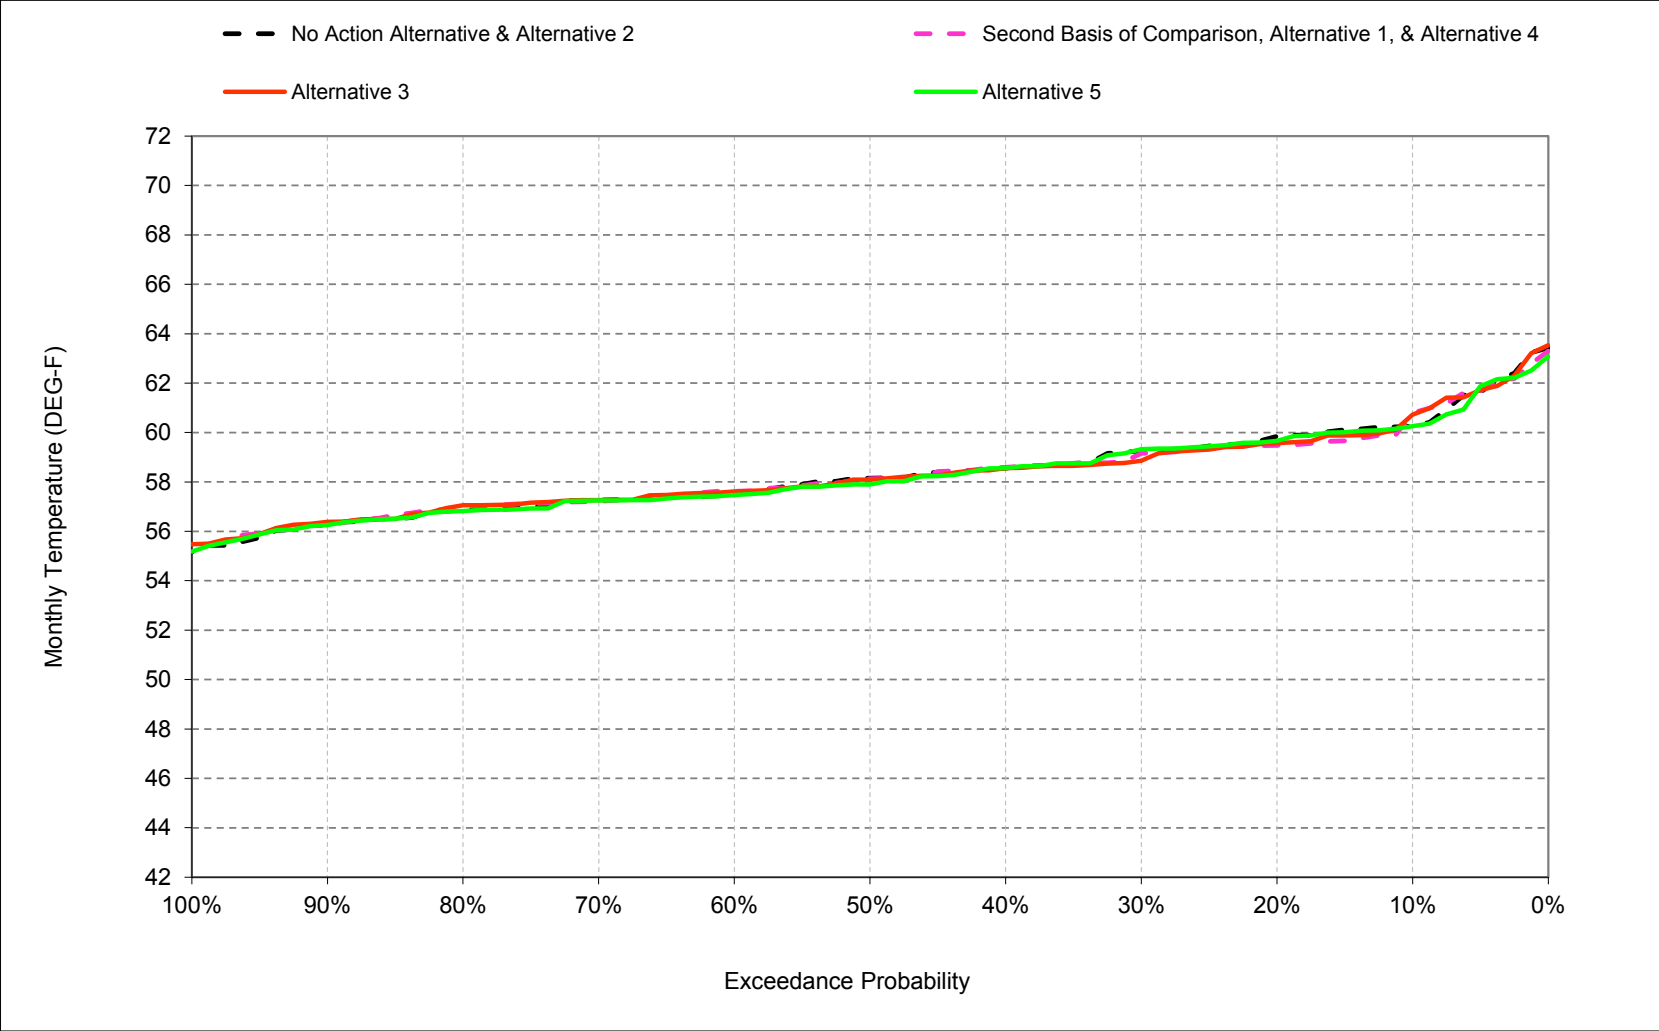


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-9-11. Sacramento River at Red Bluff, August

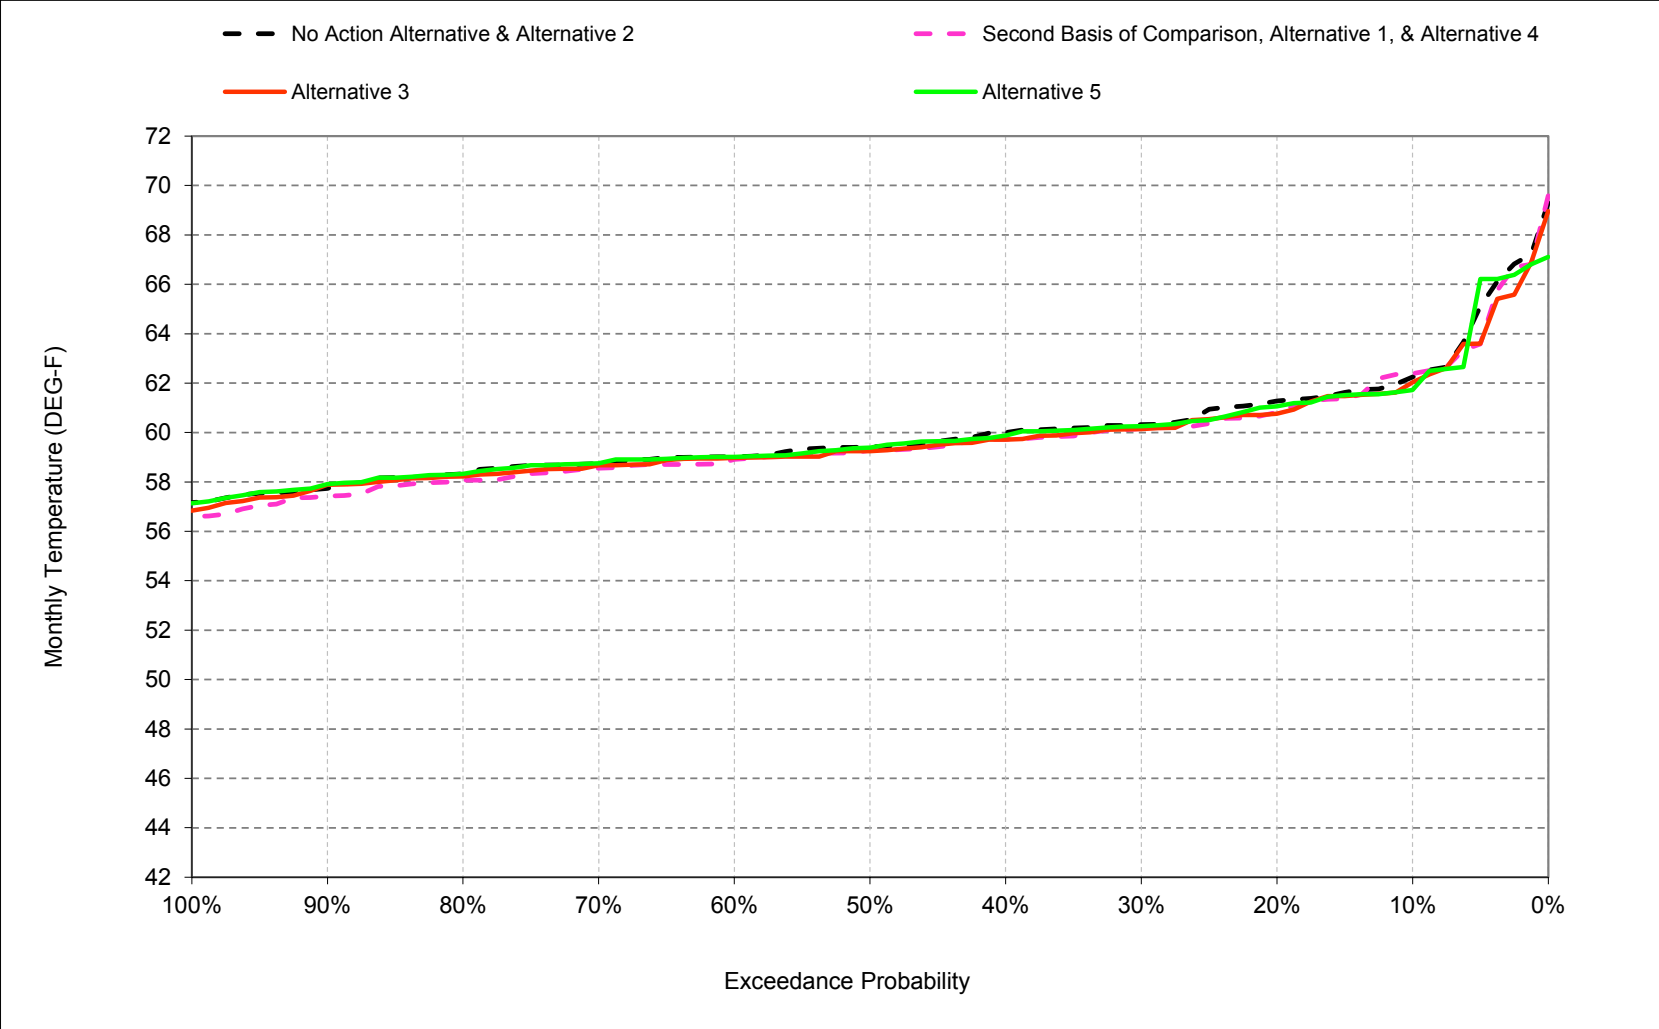

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-9-12. Sacramento River at Red Bluff, September

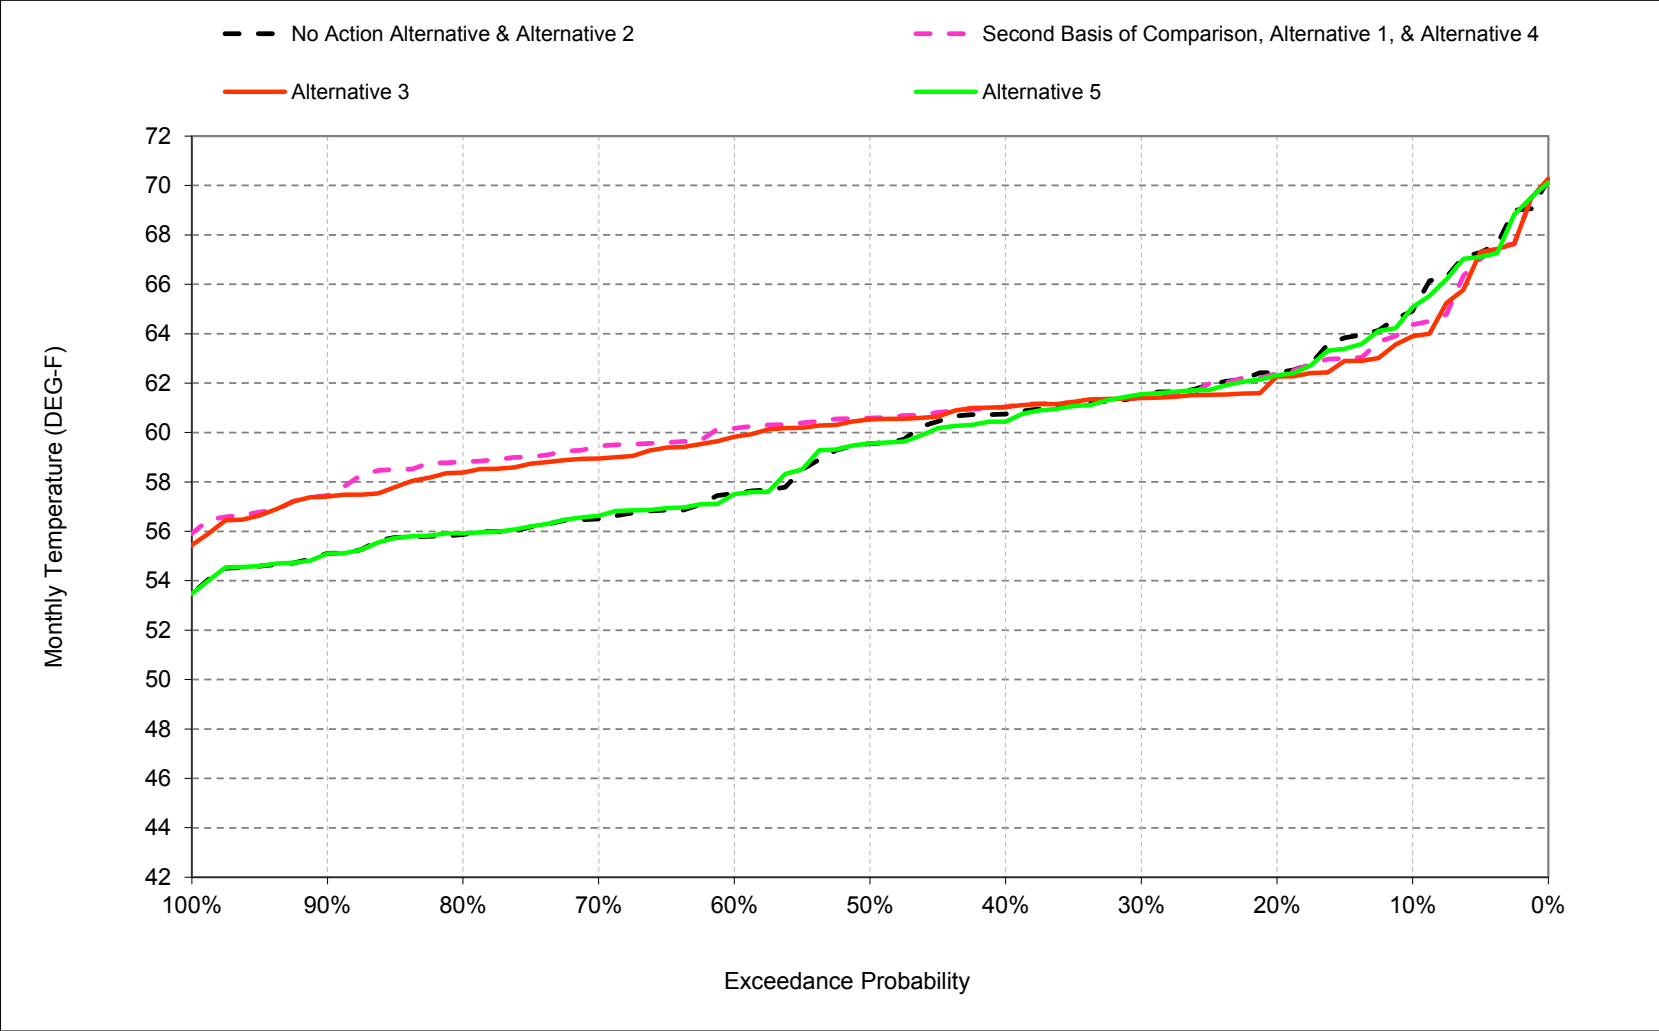

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-9-1. Sacramento River at Red Bluff, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	56	51	48	49	53	56	59	60	60	62	65
20%	58	55	50	47	49	52	56	58	59	60	61	62
30%	58	55	49	47	48	52	55	58	59	59	60	61
40%	57	54	49	47	48	51	55	57	58	59	60	61
50%	57	54	49	47	48	51	54	57	58	58	59	60
60%	57	53	48	46	47	50	54	57	58	57	59	58
70%	56	53	48	46	47	50	54	57	57	57	59	57
80%	56	53	48	46	46	49	53	56	57	57	58	56
90%	56	52	47	46	46	48	52	55	56	56	58	55
Long Term												
Full Simulation Period ^b	58	54	49	47	48	51	54	57	58	58	60	60
Water Year Types ^c												
Wet (32%)	55	51	47	46	47	49	53	57	58	58	59	56
Above Normal (16%)	58	54	49	47	47	50	54	57	57	57	58	57
Below Normal (13%)	57	54	49	47	48	52	55	57	57	57	59	61
Dry (24%)	57	54	49	47	48	52	55	57	58	58	61	62
Critical (15%)	60	55	50	47	49	52	55	58	60	61	64	66
Alternative 1												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	60	55	51	48	49	53	56	59	60	61	62	64
20%	58	55	50	48	49	52	56	58	59	59	61	62
30%	58	54	49	47	48	52	55	58	58	59	60	61
40%	57	54	49	47	48	51	55	57	58	59	60	61
50%	57	53	49	47	48	51	54	57	57	58	59	61
60%	57	53	48	46	47	50	54	57	57	58	59	60
70%	56	53	48	46	47	50	53	56	57	57	59	59
80%	56	52	48	46	47	49	53	56	56	57	58	59
90%	56	52	47	46	46	48	52	55	56	56	57	57
Long Term												
Full Simulation Period ^b	57	54	49	47	48	51	54	57	58	58	60	61
Water Year Types ^c												
Wet (32%)	55	51	47	46	47	49	53	57	58	58	59	59
Above Normal (16%)	58	53	49	47	47	50	54	57	57	57	58	59
Below Normal (13%)	57	53	49	47	48	51	54	56	57	57	58	60
Dry (24%)	57	54	49	47	48	52	55	57	57	58	61	62
Critical (15%)	59	55	50	47	49	52	55	58	59	61	63	65
Alternative 1 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.9	-0.5	0.0	-0.1	0.1	-0.3	0.0	-0.1	-0.2	0.4	0.2	-0.6
0.2	0.1	-0.7	-0.2	0.0	0.0	-0.1	0.0	-0.2	-0.3	-0.3	-0.5	-0.1
0.3	0.0	-0.6	0.1	0.0	-0.1	0.0	-0.1	-0.2	-0.2	-0.2	-0.2	0.0
0.4	0.2	-0.5	0.0	0.0	0.0	-0.1	0.0	0.0	-0.3	0.0	-0.3	0.3
0.5	0.2	-0.6	-0.2	0.0	0.0	0.0	-0.1	-0.1	-0.4	-0.1	-0.2	1.1
0.6	0.1	-0.3	0.0	0.0	0.0	-0.1	-0.1	-0.3	-0.4	0.2	-0.2	2.6
0.7	0.0	-0.2	0.2	0.0	0.0	0.1	-0.2	-0.4	-0.6	-0.1	-0.2	2.9
0.8	-0.2	-0.4	0.1	0.0	0.0	0.0	-0.1	-0.3	-0.4	0.1	-0.3	2.9
0.9	-0.1	-0.2	0.0	0.0	0.0	0.1	0.0	-0.2	-0.4	0.0	-0.3	2.4
Long Term												
Full Simulation Period ^b	-0.1	-0.4	0.0	0.0	0.0	0.0	-0.1	-0.1	-0.3	0.0	-0.3	1.2
Water Year Types ^c												
Wet (32%)	0.0	-0.3	0.2	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	-0.4	3.2
Above Normal (16%)	0.0	-0.4	-0.2	0.1	0.0	-0.1	0.0	-0.2	-0.4	0.1	-0.3	2.3
Below Normal (13%)	-0.1	-0.5	-0.3	0.1	0.0	-0.3	-0.2	-0.2	-0.5	0.0	-0.5	-0.2
Dry (24%)	0.1	-0.3	-0.2	0.0	0.0	0.0	-0.2	-0.2	-0.5	-0.2	0.1	-0.1
Critical (15%)	-0.4	-0.2	0.0	0.1	0.1	0.0	0.0	0.0	-0.5	0.0	-0.3	-0.8
<p>^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.</p> <p>^b Based on the 82-year simulation period.</p> <p>^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.</p> <p>Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.</p>												

Table B-9-2. Sacramento River at Red Bluff, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	56	51	48	49	53	56	59	60	60	62	65
20%	58	55	50	47	49	52	56	58	59	60	61	62
30%	58	55	49	47	48	52	55	58	59	59	60	61
40%	57	54	49	47	48	51	55	57	58	59	60	61
50%	57	54	49	47	48	51	54	57	58	58	59	60
60%	57	53	48	46	47	50	54	57	58	57	59	58
70%	56	53	48	46	47	50	54	57	57	57	59	57
80%	56	53	48	46	46	49	53	56	57	57	58	56
90%	56	52	47	46	46	48	52	55	56	56	58	55
Long Term												
Full Simulation Period ^b	58	54	49	47	48	51	54	57	58	58	60	60
Water Year Types ^c												
Wet (32%)	55	51	47	46	47	49	53	57	58	58	59	56
Above Normal (16%)	58	54	49	47	47	50	54	57	57	57	58	57
Below Normal (13%)	57	54	49	47	48	52	55	57	57	57	59	61
Dry (24%)	57	54	49	47	48	52	55	57	58	58	61	62
Critical (15%)	60	55	50	47	49	52	55	58	60	61	64	66

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	56	51	48	49	53	56	59	60	61	62	64
20%	58	55	50	48	49	52	56	58	59	60	61	62
30%	58	54	49	47	48	52	55	58	58	59	60	61
40%	57	54	49	47	48	51	55	57	58	59	60	61
50%	57	53	49	47	48	51	54	57	57	58	59	61
60%	57	53	48	46	47	50	54	57	57	58	59	60
70%	56	53	48	46	47	50	53	56	56	57	59	59
80%	56	52	48	46	47	49	53	56	56	57	58	58
90%	56	52	47	46	46	48	52	55	56	56	58	57
Long Term												
Full Simulation Period ^b	57	54	49	47	48	51	54	57	58	58	60	61
Water Year Types ^c												
Wet (32%)	55	51	47	46	47	49	53	57	58	58	59	59
Above Normal (16%)	58	53	49	47	47	50	54	57	57	57	58	59
Below Normal (13%)	57	53	49	47	48	51	55	57	57	57	59	59
Dry (24%)	57	53	49	47	48	52	55	57	57	58	60	62
Critical (15%)	59	55	50	47	49	52	55	58	59	61	63	65

Alternative 3 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.4	-0.1	0.0	-0.2	0.0	-0.3	0.0	-0.2	-0.1	0.4	-0.2	-1.0
0.2	-0.1	-0.6	-0.3	0.0	0.0	-0.1	0.0	-0.1	-0.3	-0.2	-0.5	-0.3
0.3	0.1	-0.5	0.1	0.1	-0.1	0.0	0.0	0.0	-0.2	-0.4	-0.2	0.0
0.4	0.1	-0.5	0.0	0.0	0.0	-0.2	0.0	-0.1	-0.2	0.0	-0.3	0.3
0.5	0.1	-0.7	-0.2	0.0	0.0	-0.1	-0.1	0.0	-0.3	0.0	-0.2	1.0
0.6	0.1	-0.3	0.0	0.0	-0.1	-0.1	0.0	-0.4	-0.5	0.1	-0.1	2.3
0.7	0.0	-0.2	0.1	0.0	0.0	0.1	-0.1	-0.3	-0.7	0.0	-0.1	2.4
0.8	-0.2	-0.4	0.0	0.1	0.0	0.0	0.0	-0.3	-0.4	0.1	-0.1	2.5
0.9	-0.2	-0.2	0.0	0.0	0.0	0.1	0.0	-0.1	-0.1	0.1	0.0	2.3
Long Term												
Full Simulation Period ^b	-0.1	-0.4	0.0	0.0	0.0	0.0	0.0	-0.1	-0.3	0.0	-0.2	1.0
Water Year Types ^c												
Wet (32%)	0.0	-0.3	0.2	0.0	0.0	0.0	0.0	0.0	-0.2	0.0	-0.2	3.0
Above Normal (16%)	0.0	-0.4	-0.2	0.0	0.0	-0.1	0.0	-0.3	-0.3	0.1	0.0	2.3
Below Normal (13%)	-0.2	-0.5	-0.3	0.1	0.0	-0.3	-0.1	-0.2	-0.3	-0.1	-0.2	-1.1
Dry (24%)	-0.1	-0.4	-0.1	0.0	0.0	0.0	-0.1	-0.2	-0.5	-0.2	-0.2	-0.2
Critical (15%)	-0.4	-0.2	0.0	0.1	0.1	0.0	0.1	0.0	-0.4	0.2	-0.5	-0.9

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
^b Based on the 82-year simulation period.
^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-9-3. Sacramento River at Red Bluff, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	56	51	48	49	53	56	59	60	60	62	65
20%	58	55	50	47	49	52	56	58	59	60	61	62
30%	58	55	49	47	48	52	55	58	59	59	60	61
40%	57	54	49	47	48	51	55	57	58	59	60	61
50%	57	54	49	47	48	51	54	57	58	58	59	60
60%	57	53	48	46	47	50	54	57	58	57	59	58
70%	56	53	48	46	47	50	54	57	57	57	59	57
80%	56	53	48	46	46	49	53	56	57	57	58	56
90%	56	52	47	46	46	48	52	55	56	56	58	55
Long Term												
Full Simulation Period ^b	58	54	49	47	48	51	54	57	58	58	60	60
Water Year Types ^c												
Wet (32%)	55	51	47	46	47	49	53	57	58	58	59	56
Above Normal (16%)	58	54	49	47	47	50	54	57	57	57	58	57
Below Normal (13%)	57	54	49	47	48	52	55	57	57	57	59	61
Dry (24%)	57	54	49	47	48	52	55	57	58	58	61	62
Critical (15%)	60	55	50	47	49	52	55	58	60	61	64	66

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	56	51	48	49	53	56	59	60	60	62	65
20%	58	55	50	48	49	52	56	59	59	60	61	62
30%	58	55	49	47	48	52	55	58	59	59	60	62
40%	57	54	49	47	48	51	55	58	58	59	60	60
50%	57	54	49	47	48	51	54	57	58	58	59	60
60%	56	53	48	46	47	50	54	57	58	57	59	58
70%	56	53	48	46	47	50	54	57	57	57	59	57
80%	56	53	48	46	47	49	53	56	57	57	58	56
90%	56	52	47	46	46	48	52	56	56	56	58	55
Long Term												
Full Simulation Period ^b	58	54	49	47	48	51	54	57	58	58	60	60
Water Year Types ^c												
Wet (32%)	55	51	47	46	47	49	53	57	58	58	59	56
Above Normal (16%)	58	54	49	47	47	50	54	57	57	57	58	57
Below Normal (13%)	57	54	49	47	48	52	55	57	57	57	59	60
Dry (24%)	57	54	49	47	48	52	55	58	58	58	60	62
Critical (15%)	60	55	50	47	49	52	55	58	60	61	63	66

Alternative 5 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.5	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	-0.5	0.1
0.2	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.2	0.0	-0.2	-0.2	-0.1
0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-0.1	0.1
0.4	0.0	0.0	-0.1	-0.1	0.0	0.0	0.1	0.1	0.0	0.0	-0.2	-0.3
0.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.2	0.0	0.0
0.6	-0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0
0.7	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.1
0.8	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.2	0.0	0.0	0.0	0.0
0.9	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.2	0.0	0.0	0.1	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	-0.1	-0.1	-0.1
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.1
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.2	-0.1
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.0	-0.1	-0.3	-0.2
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.2	0.2	-0.2	-0.3	-0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-9-4. Sacramento River at Red Bluff, Monthly Temperature

Second Basis of Comparison		Monthly Temperature (DEG-F)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	60	55	51	48	49	53	56	59	60	61	62	64	
20%	58	55	50	48	49	52	56	58	59	59	61	62	
30%	58	54	49	47	48	52	55	58	58	59	60	61	
40%	57	54	49	47	48	51	55	57	58	59	60	61	
50%	57	53	49	47	48	51	54	57	57	58	59	61	
60%	57	53	48	46	47	50	54	57	57	58	59	60	
70%	56	53	48	46	47	50	53	56	57	57	59	59	
80%	56	52	48	46	47	49	53	56	56	57	58	59	
90%	56	52	47	46	46	48	52	55	56	56	57	57	
Long Term													
Full Simulation Period ^b	57	54	49	47	48	51	54	57	58	58	60	61	
Water Year Types^c													
Wet (32%)	55	51	47	46	47	49	53	57	58	58	59	59	
Above Normal (16%)	58	53	49	47	47	50	54	57	57	57	58	59	
Below Normal (13%)	57	53	49	47	48	51	54	56	57	57	58	60	
Dry (24%)	57	54	49	47	48	52	55	57	57	58	61	62	
Critical (15%)	59	55	50	47	49	52	55	58	59	61	63	65	

No Action Alternative		Monthly Temperature (DEG-F)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	61	56	51	48	49	53	56	59	60	60	62	65	
20%	58	55	50	47	49	52	56	58	59	60	61	62	
30%	58	55	49	47	48	52	55	58	59	59	60	61	
40%	57	54	49	47	48	51	55	57	58	59	60	61	
50%	57	54	49	47	48	51	54	57	58	58	59	60	
60%	57	53	48	46	47	50	54	57	58	57	59	58	
70%	56	53	48	46	47	50	54	57	57	57	59	57	
80%	56	53	48	46	46	49	53	56	57	57	58	56	
90%	56	52	47	46	46	48	52	55	56	56	58	55	
Long Term													
Full Simulation Period ^b	58	54	49	47	48	51	54	57	58	58	60	60	
Water Year Types^c													
Wet (32%)	55	51	47	46	47	49	53	57	58	58	59	56	
Above Normal (16%)	58	54	49	47	47	50	54	57	57	57	58	57	
Below Normal (13%)	57	54	49	47	48	52	55	57	57	57	59	61	
Dry (24%)	57	54	49	47	48	52	55	57	58	58	61	62	
Critical (15%)	60	55	50	47	49	52	55	58	60	61	64	66	

No Action Alternative minus Second Basis of Comparison		Monthly Temperature (DEG-F)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
0.1	0.9	0.5	0.0	0.1	-0.1	0.3	0.0	0.1	0.2	-0.4	-0.2	0.6	
0.2	-0.1	0.7	0.2	0.0	0.0	0.1	0.0	0.2	0.3	0.3	0.5	0.1	
0.3	0.0	0.6	-0.1	0.0	0.1	0.0	0.1	0.1	0.2	0.2	0.2	0.0	
0.4	-0.2	0.5	0.0	0.0	0.0	0.1	0.0	0.0	0.3	0.0	0.3	-0.3	
0.5	-0.2	0.6	0.2	0.0	0.0	0.0	0.1	0.1	0.4	0.1	0.2	-1.1	
0.6	-0.1	0.3	0.0	0.0	0.0	0.1	0.1	0.3	0.4	-0.2	0.2	-2.6	
0.7	0.0	0.2	-0.2	0.0	0.0	-0.1	0.2	0.4	0.6	0.1	0.2	-2.9	
0.8	0.2	0.4	-0.1	0.0	0.0	0.0	0.1	0.3	0.4	-0.1	0.3	-2.9	
0.9	0.1	0.2	0.0	0.0	0.0	-0.1	0.0	0.2	0.4	0.0	0.3	-2.4	
Long Term													
Full Simulation Period ^b	0.1	0.4	0.0	0.0	0.0	0.0	0.1	0.1	0.3	0.0	0.3	-1.2	
Water Year Types^c													
Wet (32%)	0.0	0.3	-0.2	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.4	-3.2	
Above Normal (16%)	0.0	0.4	0.2	-0.1	0.0	0.1	0.0	0.2	0.4	-0.1	0.3	-2.3	
Below Normal (13%)	0.1	0.5	0.3	-0.1	0.0	0.3	0.2	0.2	0.5	0.0	0.5	0.2	
Dry (24%)	-0.1	0.3	0.2	0.0	0.0	0.0	0.2	0.2	0.5	0.2	-0.1	0.1	
Critical (15%)	0.4	0.2	0.0	-0.1	-0.1	0.0	0.0	0.0	0.5	0.0	0.3	0.8	

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-9-5. Sacramento River at Red Bluff, Monthly Temperature

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	60	55	51	48	49	53	56	59	60	61	62	64
20%	58	55	50	48	49	52	56	58	59	59	61	62
30%	58	54	49	47	48	52	55	58	58	59	60	61
40%	57	54	49	47	48	51	55	57	58	59	60	61
50%	57	53	49	47	48	51	54	57	57	58	59	61
60%	57	53	48	46	47	50	54	57	57	58	59	60
70%	56	53	48	46	47	50	53	56	57	57	59	59
80%	56	52	48	46	47	49	53	56	56	57	58	59
90%	56	52	47	46	46	48	52	55	56	56	57	57
Long Term												
Full Simulation Period ^b	57	54	49	47	48	51	54	57	58	58	60	61
Water Year Types ^c												
Wet (32%)	55	51	47	46	47	49	53	57	58	58	59	59
Above Normal (16%)	58	53	49	47	47	50	54	57	57	57	58	59
Below Normal (13%)	57	53	49	47	48	51	54	56	57	57	58	60
Dry (24%)	57	54	49	47	48	52	55	57	57	58	61	62
Critical (15%)	59	55	50	47	49	52	55	58	59	61	63	65

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 3												
Probability of Exceedance ^a												
10%	61	56	51	48	49	53	56	59	60	61	62	64
20%	58	55	50	48	49	52	56	58	59	60	61	62
30%	58	54	49	47	48	52	55	58	58	59	60	61
40%	57	54	49	47	48	51	55	57	58	59	60	61
50%	57	53	49	47	48	51	54	57	57	58	59	61
60%	57	53	48	46	47	50	54	57	57	58	59	60
70%	56	53	48	46	47	50	53	56	56	57	59	59
80%	56	52	48	46	47	49	53	56	56	57	58	58
90%	56	52	47	46	46	48	52	55	56	56	58	57
Long Term												
Full Simulation Period ^b	57	54	49	47	48	51	54	57	58	58	60	61
Water Year Types ^c												
Wet (32%)	55	51	47	46	47	49	53	57	58	58	59	59
Above Normal (16%)	58	53	49	47	47	50	54	57	57	57	58	59
Below Normal (13%)	57	53	49	47	48	51	55	57	57	57	59	59
Dry (24%)	57	53	49	47	48	52	55	57	57	58	60	62
Critical (15%)	59	55	50	47	49	52	55	58	59	61	63	65

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 3 minus Second Basis of Comparison												
Probability of Exceedance ^a												
0.1	0.5	0.4	0.0	0.0	-0.1	0.0	0.0	-0.1	0.1	0.0	-0.4	-0.5
0.2	-0.3	0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.1	0.0	-0.2
0.3	0.1	0.0	0.0	0.1	0.0	0.0	0.1	0.1	0.0	0.0	-0.2	0.0
0.4	-0.2	0.0	0.0	0.0	0.1	0.0	-0.1	-0.1	0.1	-0.1	0.0	0.0
0.5	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	-0.1
0.6	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	-0.1	0.0	0.2	-0.3
0.7	0.0	0.0	-0.1	0.0	0.0	0.0	0.1	0.0	-0.1	0.1	0.1	-0.5
0.8	0.0	-0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.1	0.2	-0.4
0.9	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.3	0.1	0.3	-0.1
Long Term												
Full Simulation Period ^b	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.2
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.2	-0.2
Above Normal (16%)	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.0	0.3	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.1	0.0	0.4	-1.0
Dry (24%)	-0.2	-0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	-0.3	-0.1
Critical (15%)	0.0	0.1	0.0	-0.1	-0.1	0.0	0.0	0.0	0.1	0.2	-0.2	-0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-9-6. Sacramento River at Red Bluff, Monthly Temperature

Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	60	55	51	48	49	53	56	59	60	61	62	64
20%	58	55	50	48	49	52	56	58	59	59	61	62
30%	58	54	49	47	48	52	55	58	58	59	60	61
40%	57	54	49	47	48	51	55	57	58	59	60	61
50%	57	53	49	47	48	51	54	57	57	58	59	61
60%	57	53	48	46	47	50	54	57	57	58	59	60
70%	56	53	48	46	47	50	53	56	57	57	59	59
80%	56	52	48	46	47	49	53	56	56	57	58	59
90%	56	52	47	46	46	48	52	55	56	56	57	57
Long Term												
Full Simulation Period ^b	57	54	49	47	48	51	54	57	58	58	60	61
Water Year Types ^c												
Wet (32%)	55	51	47	46	47	49	53	57	58	58	59	59
Above Normal (16%)	58	53	49	47	47	50	54	57	57	57	58	59
Below Normal (13%)	57	53	49	47	48	51	54	56	57	57	58	60
Dry (24%)	57	54	49	47	48	52	55	57	57	58	61	62
Critical (15%)	59	55	50	47	49	52	55	58	59	61	63	65

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	56	51	48	49	53	56	59	60	60	62	65
20%	58	55	50	48	49	52	56	59	59	60	61	62
30%	58	55	49	47	48	52	55	58	59	59	60	62
40%	57	54	49	47	48	51	55	58	58	59	60	60
50%	57	54	49	47	48	51	54	57	58	58	59	60
60%	56	53	48	46	47	50	54	57	58	57	59	58
70%	56	53	48	46	47	50	54	57	57	57	59	57
80%	56	53	48	46	47	49	53	56	57	57	58	56
90%	56	52	47	46	46	48	52	56	56	56	58	55
Long Term												
Full Simulation Period ^b	58	54	49	47	48	51	54	57	58	58	60	60
Water Year Types ^c												
Wet (32%)	55	51	47	46	47	49	53	57	58	58	59	56
Above Normal (16%)	58	54	49	47	47	50	54	57	57	57	58	57
Below Normal (13%)	57	54	49	47	48	52	55	57	57	57	59	60
Dry (24%)	57	54	49	47	48	52	55	58	58	58	60	62
Critical (15%)	60	55	50	47	49	52	55	58	60	61	63	66

Alternative 5 minus Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	1.4	0.4	-0.1	0.1	-0.1	0.3	0.0	0.1	0.3	-0.4	-0.7	0.7
0.2	-0.1	0.6	0.3	0.0	0.0	0.1	0.0	0.4	0.3	0.2	0.3	-0.1
0.3	0.0	0.5	-0.1	0.0	0.1	0.1	0.1	0.2	0.2	0.2	0.1	0.1
0.4	-0.2	0.5	0.0	-0.1	0.0	0.1	0.0	0.1	0.3	0.0	0.1	-0.6
0.5	-0.2	0.6	0.2	0.0	0.0	0.0	0.1	0.2	0.5	-0.2	0.1	-1.1
0.6	-0.2	0.4	0.1	0.0	0.1	0.1	0.1	0.3	0.5	-0.2	0.2	-2.7
0.7	-0.1	0.2	-0.2	0.0	0.0	-0.1	0.3	0.4	0.6	0.0	0.2	-2.8
0.8	0.1	0.5	-0.1	0.0	0.0	0.0	0.1	0.5	0.4	-0.1	0.3	-2.9
0.9	0.1	0.2	0.0	0.0	0.0	-0.1	0.0	0.4	0.4	0.0	0.4	-2.4
Long Term												
Full Simulation Period ^b	0.1	0.3	0.0	0.0	0.0	0.0	0.1	0.2	0.4	0.0	0.2	-1.3
Water Year Types ^c												
Wet (32%)	0.0	0.3	-0.2	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.4	-3.2
Above Normal (16%)	0.0	0.3	0.2	-0.1	0.0	0.1	0.0	0.3	0.4	-0.1	0.3	-2.2
Below Normal (13%)	0.1	0.4	0.3	0.0	0.0	0.3	0.2	0.3	0.5	0.0	0.7	0.0
Dry (24%)	0.0	0.3	0.1	0.0	0.0	0.0	0.2	0.5	0.5	0.1	-0.4	0.0
Critical (15%)	0.4	0.3	0.0	-0.2	-0.2	0.0	0.1	0.2	0.6	-0.2	0.0	0.7

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


B.10. Sacramento River at Hamilton City Temperature

Figure B-10-1. Sacramento River below Hamilton City, October

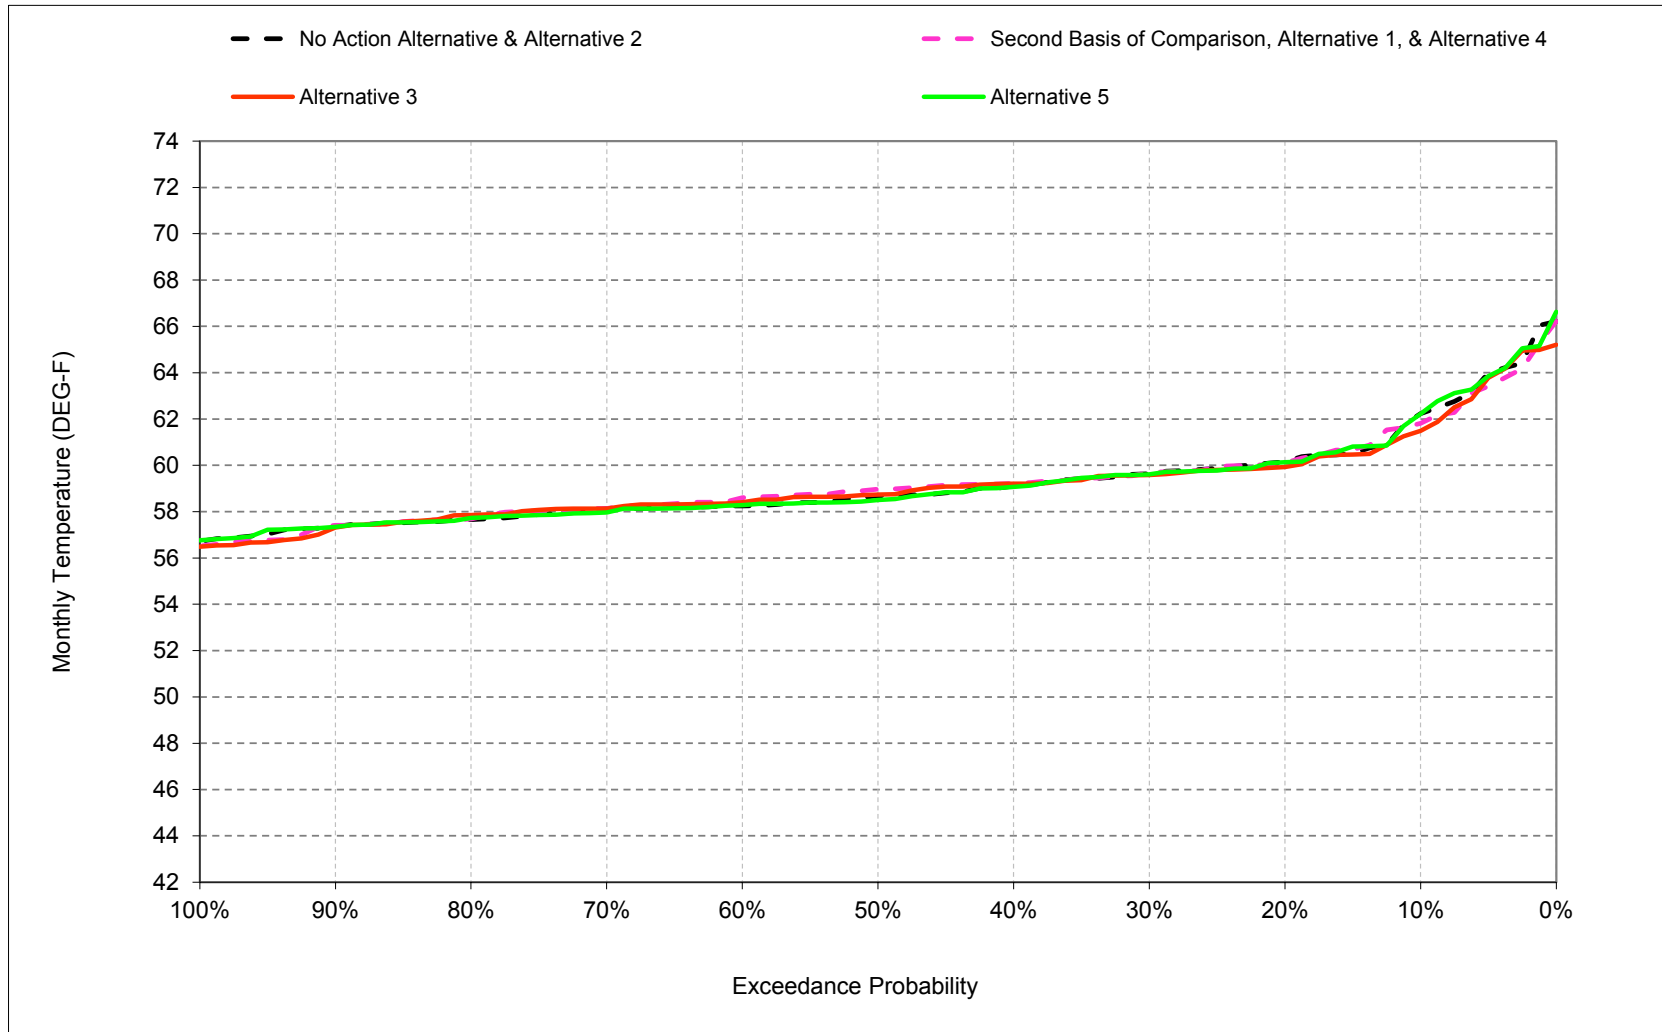


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-10-2. Sacramento River below Hamilton City, November

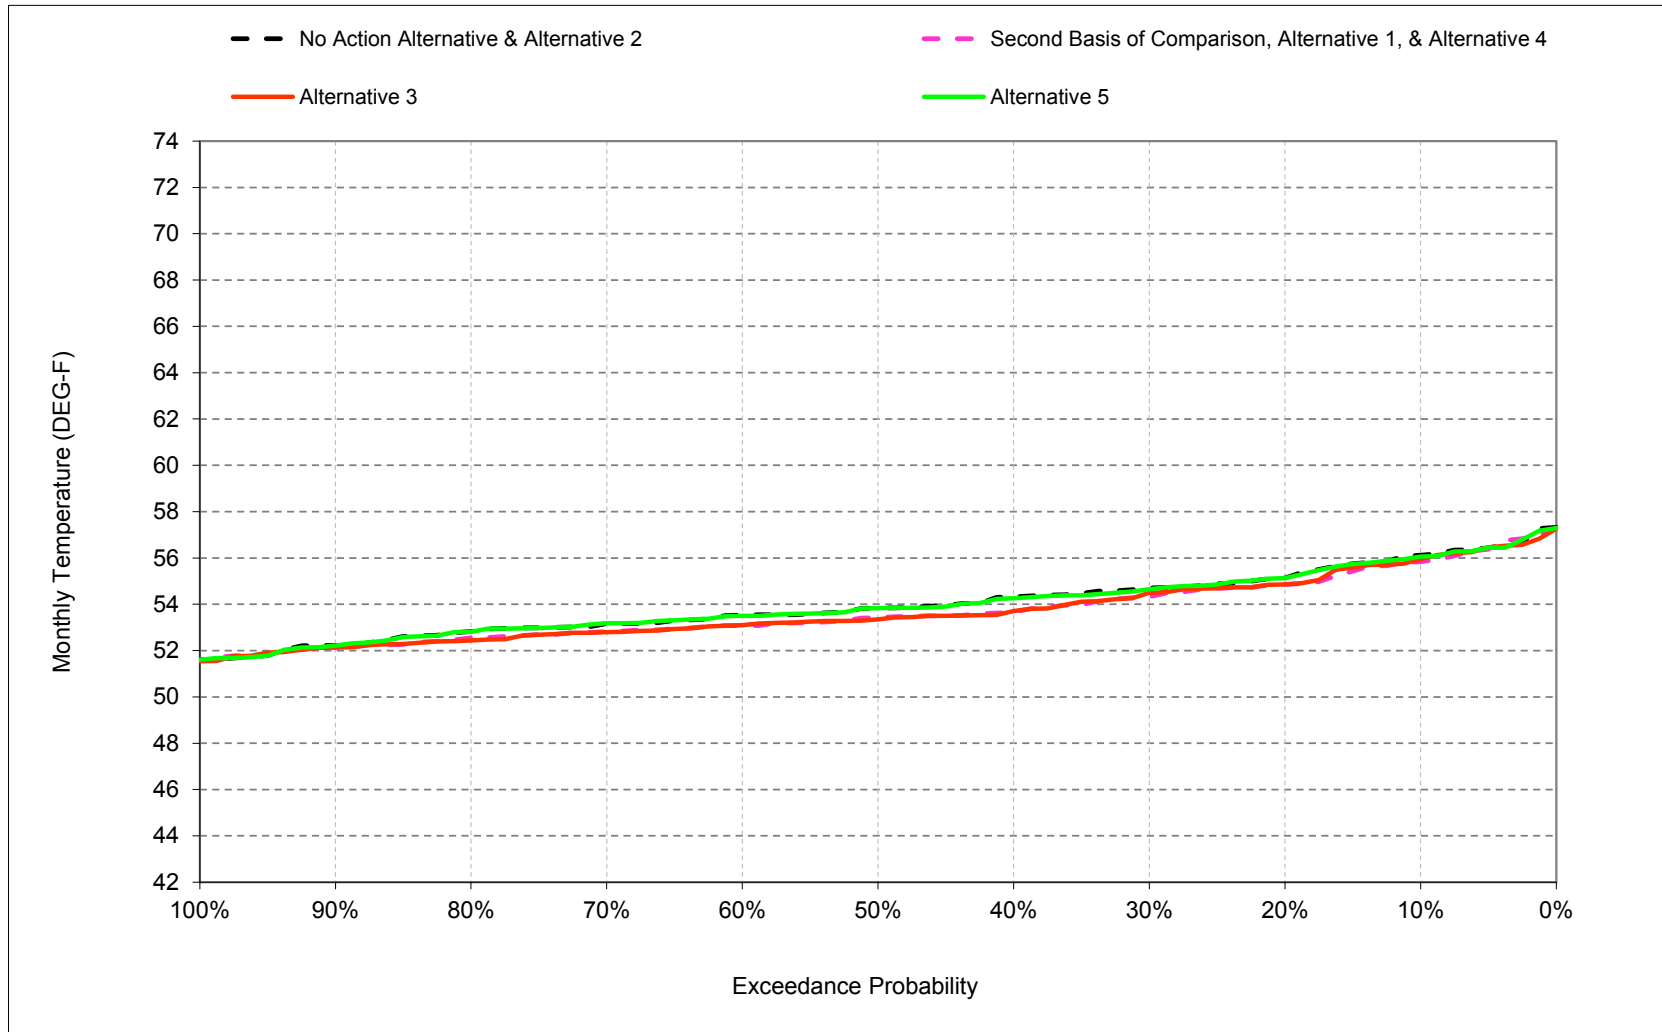


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-10-3. Sacramento River below Hamilton City, December

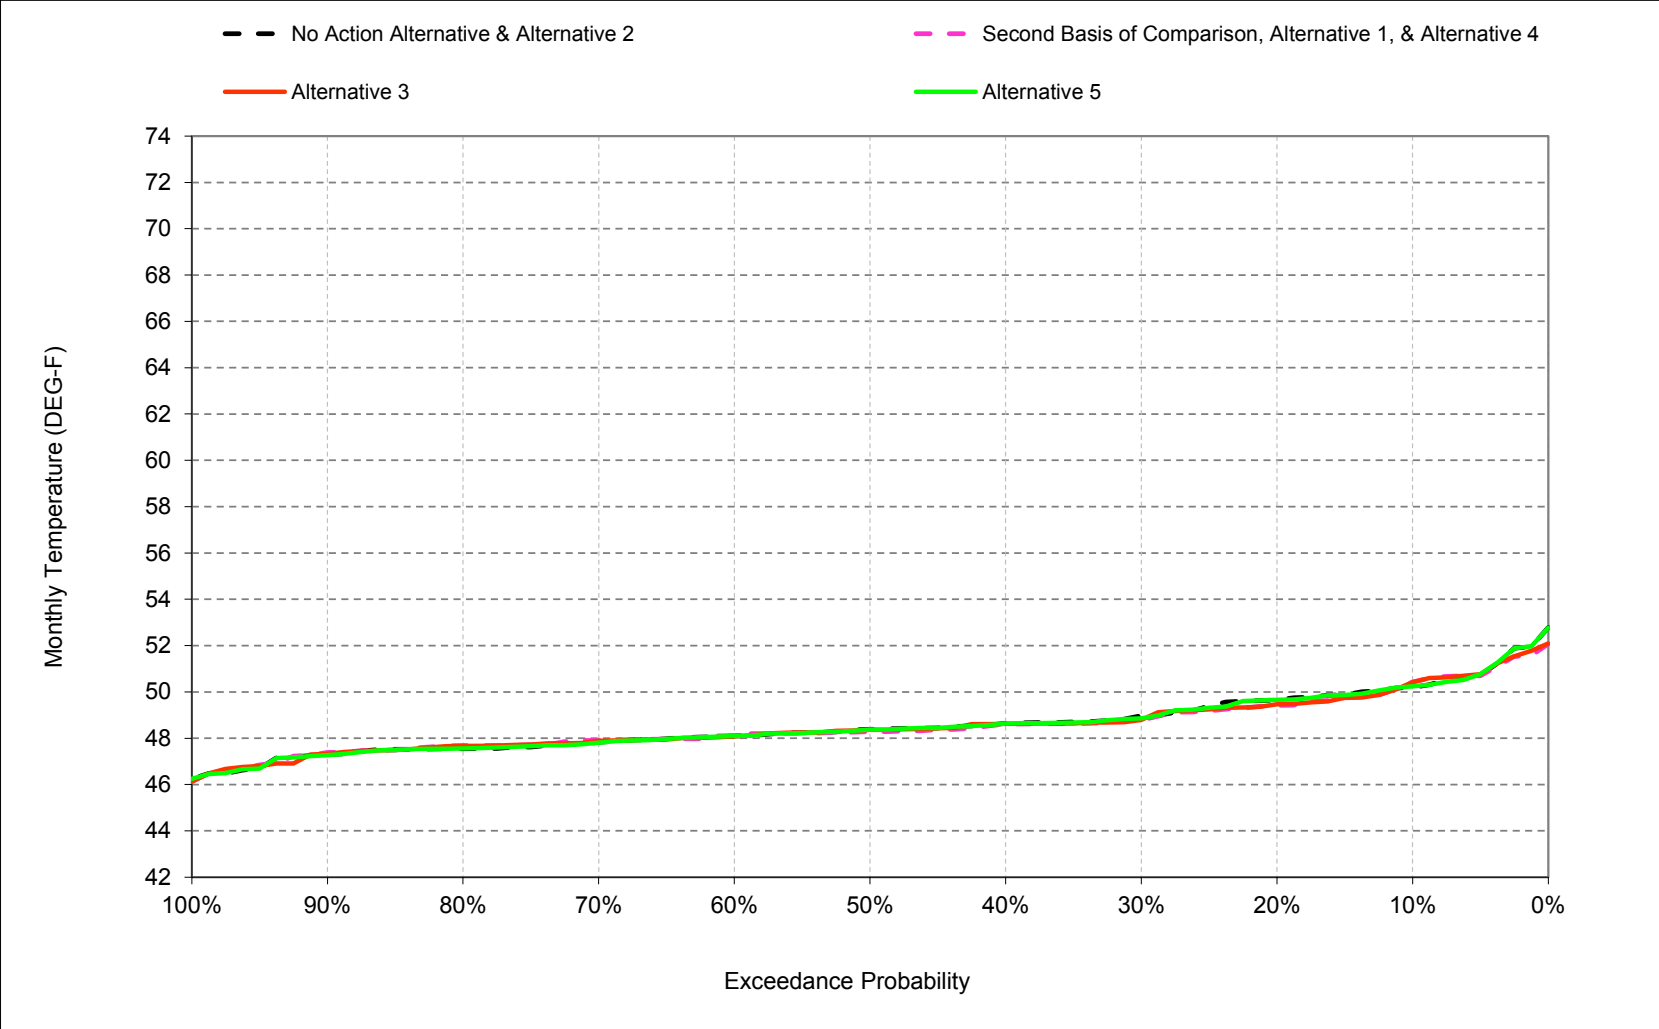


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-10-4. Sacramento River below Hamilton City, January

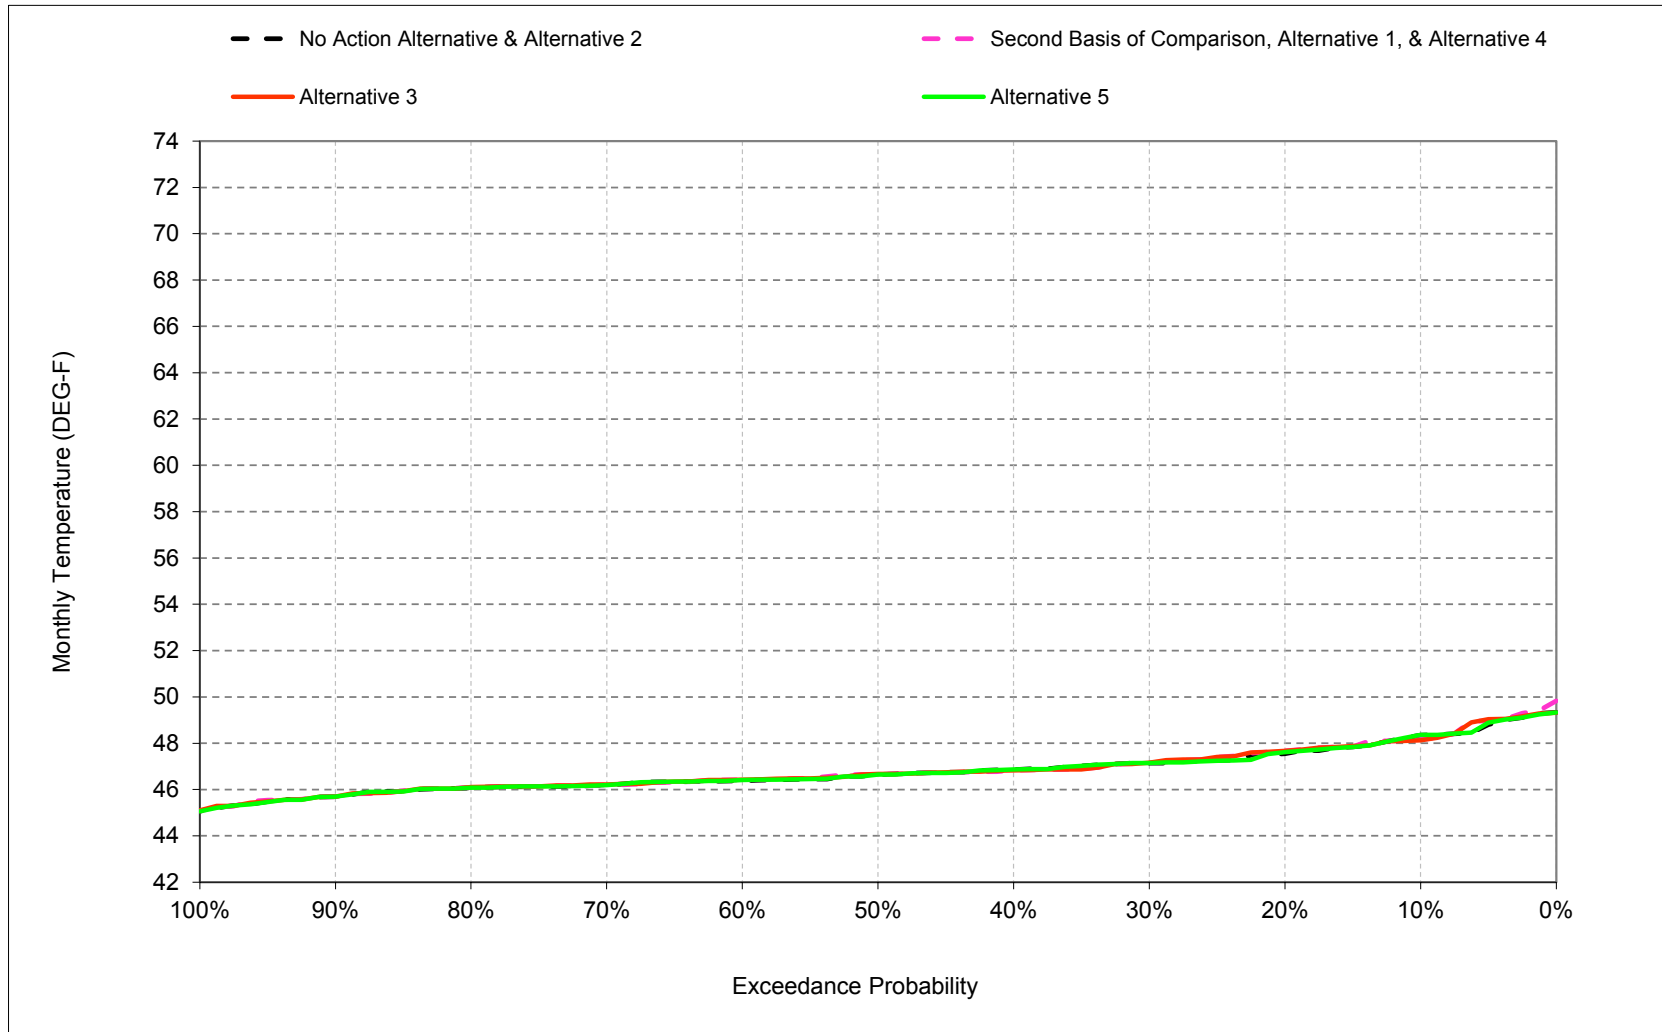


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-10-5. Sacramento River below Hamilton City, February

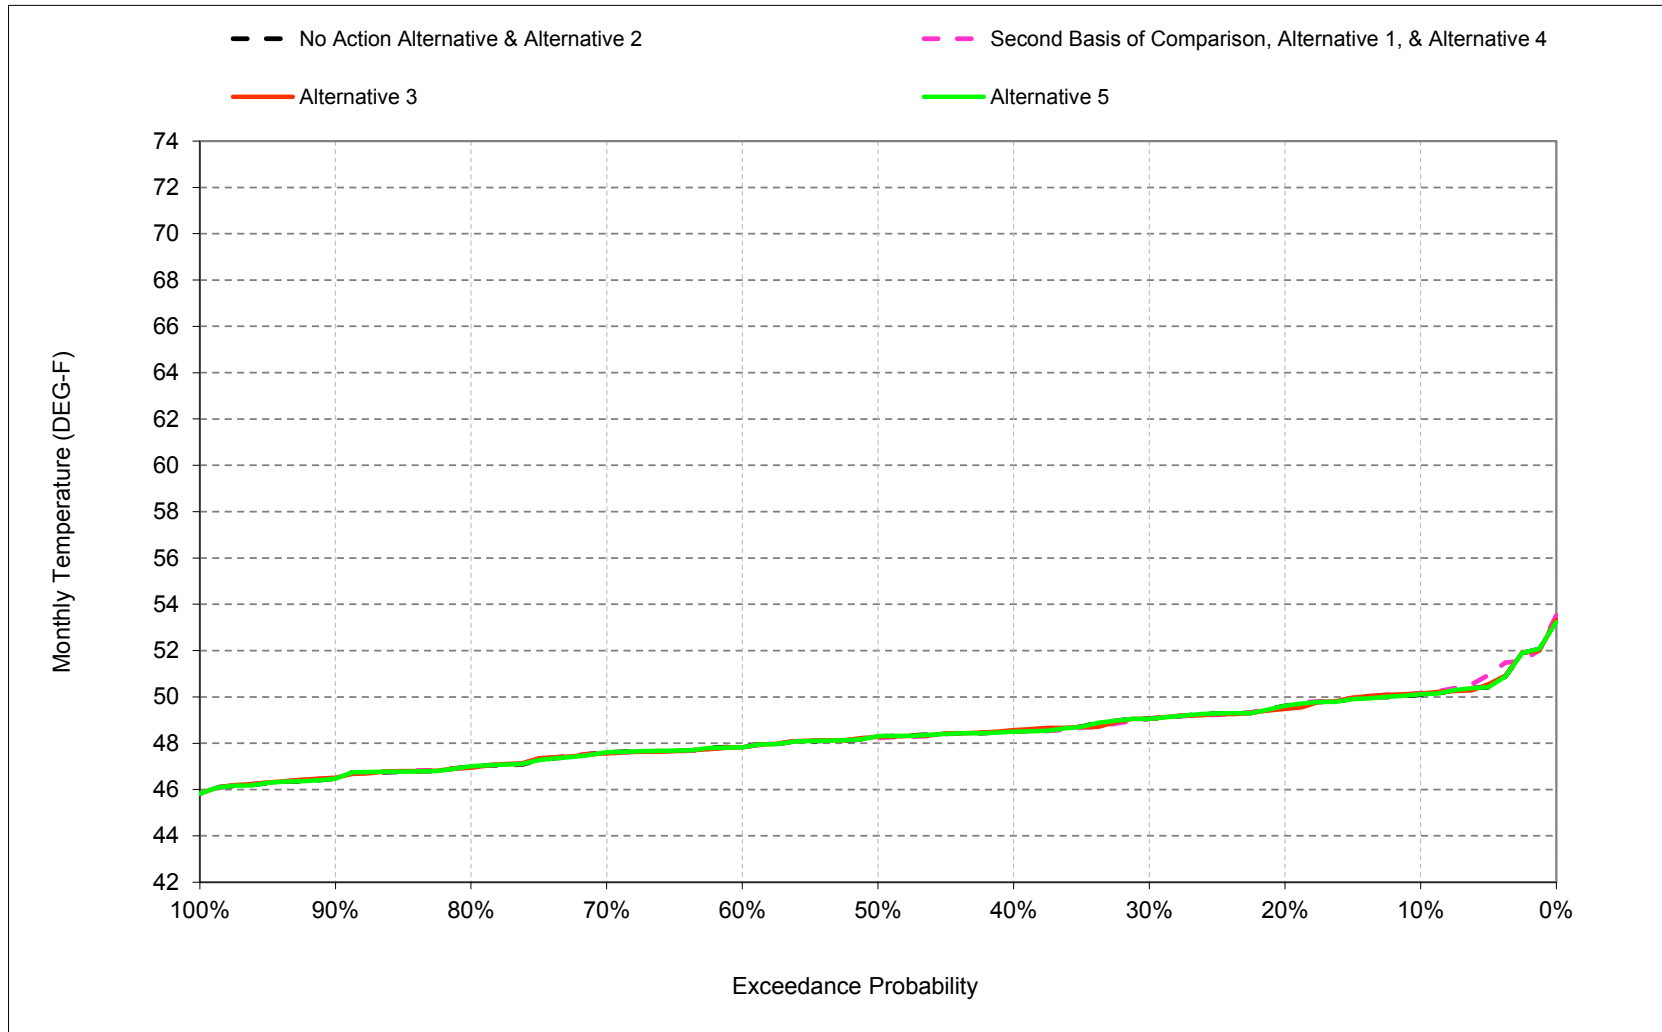


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-10-6. Sacramento River below Hamilton City, March

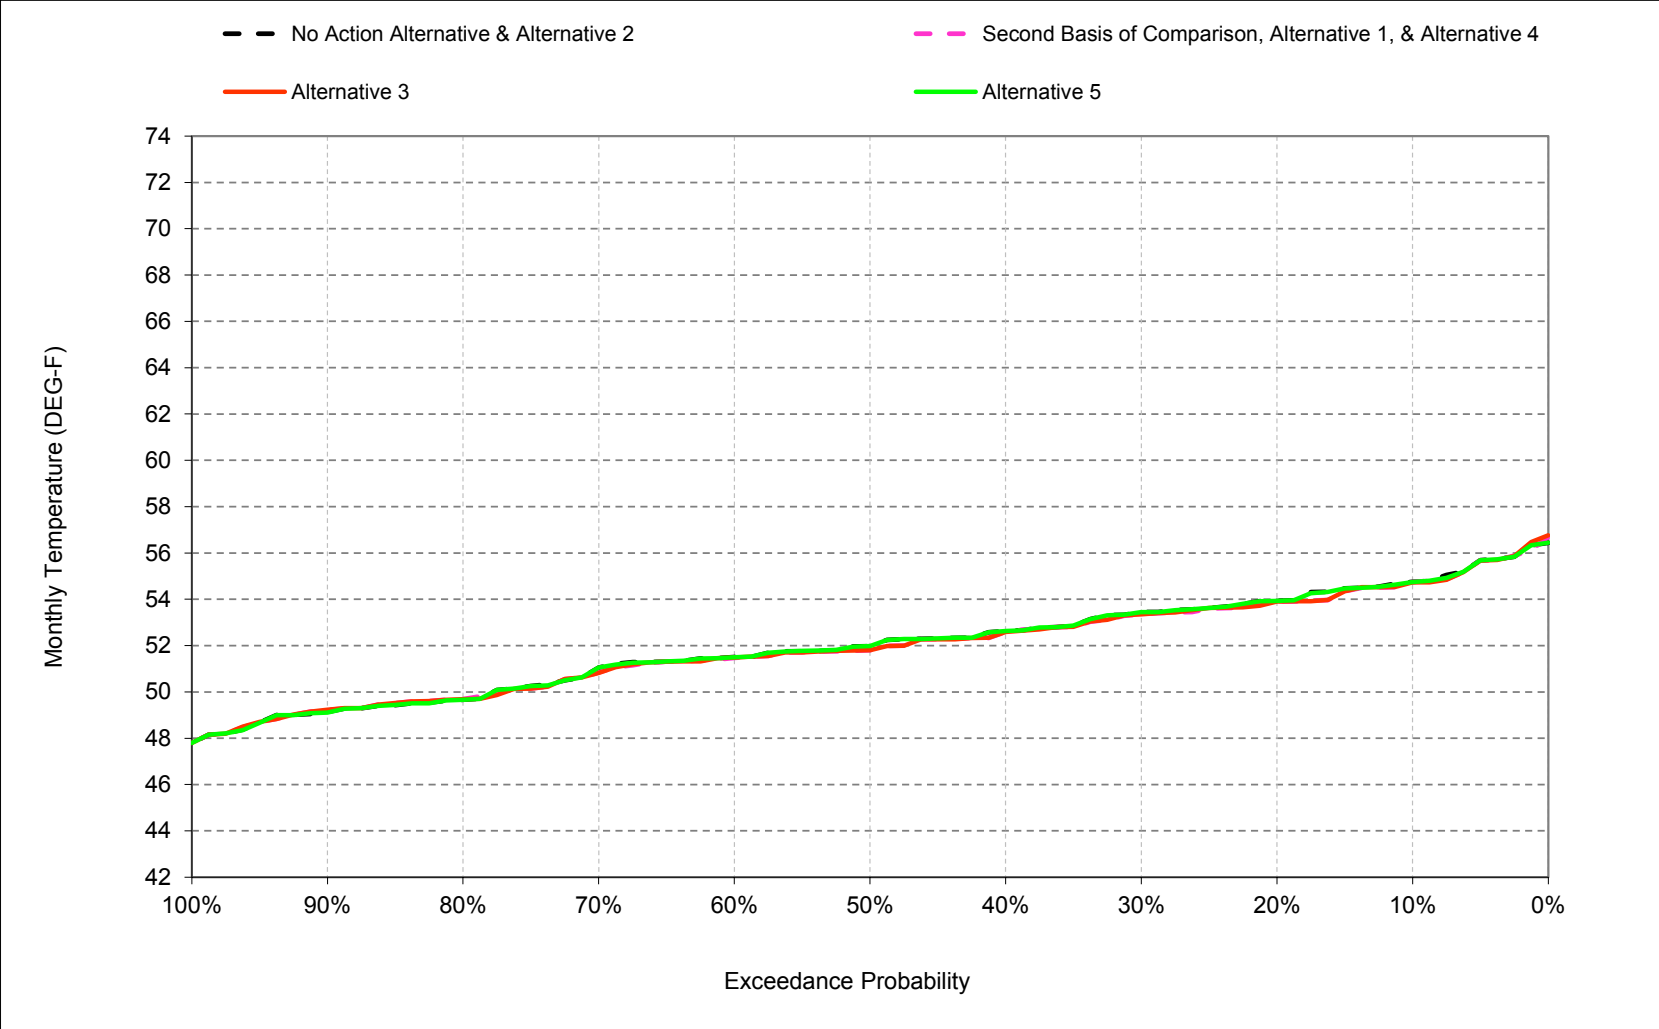


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-10-7. Sacramento River below Hamilton City, April

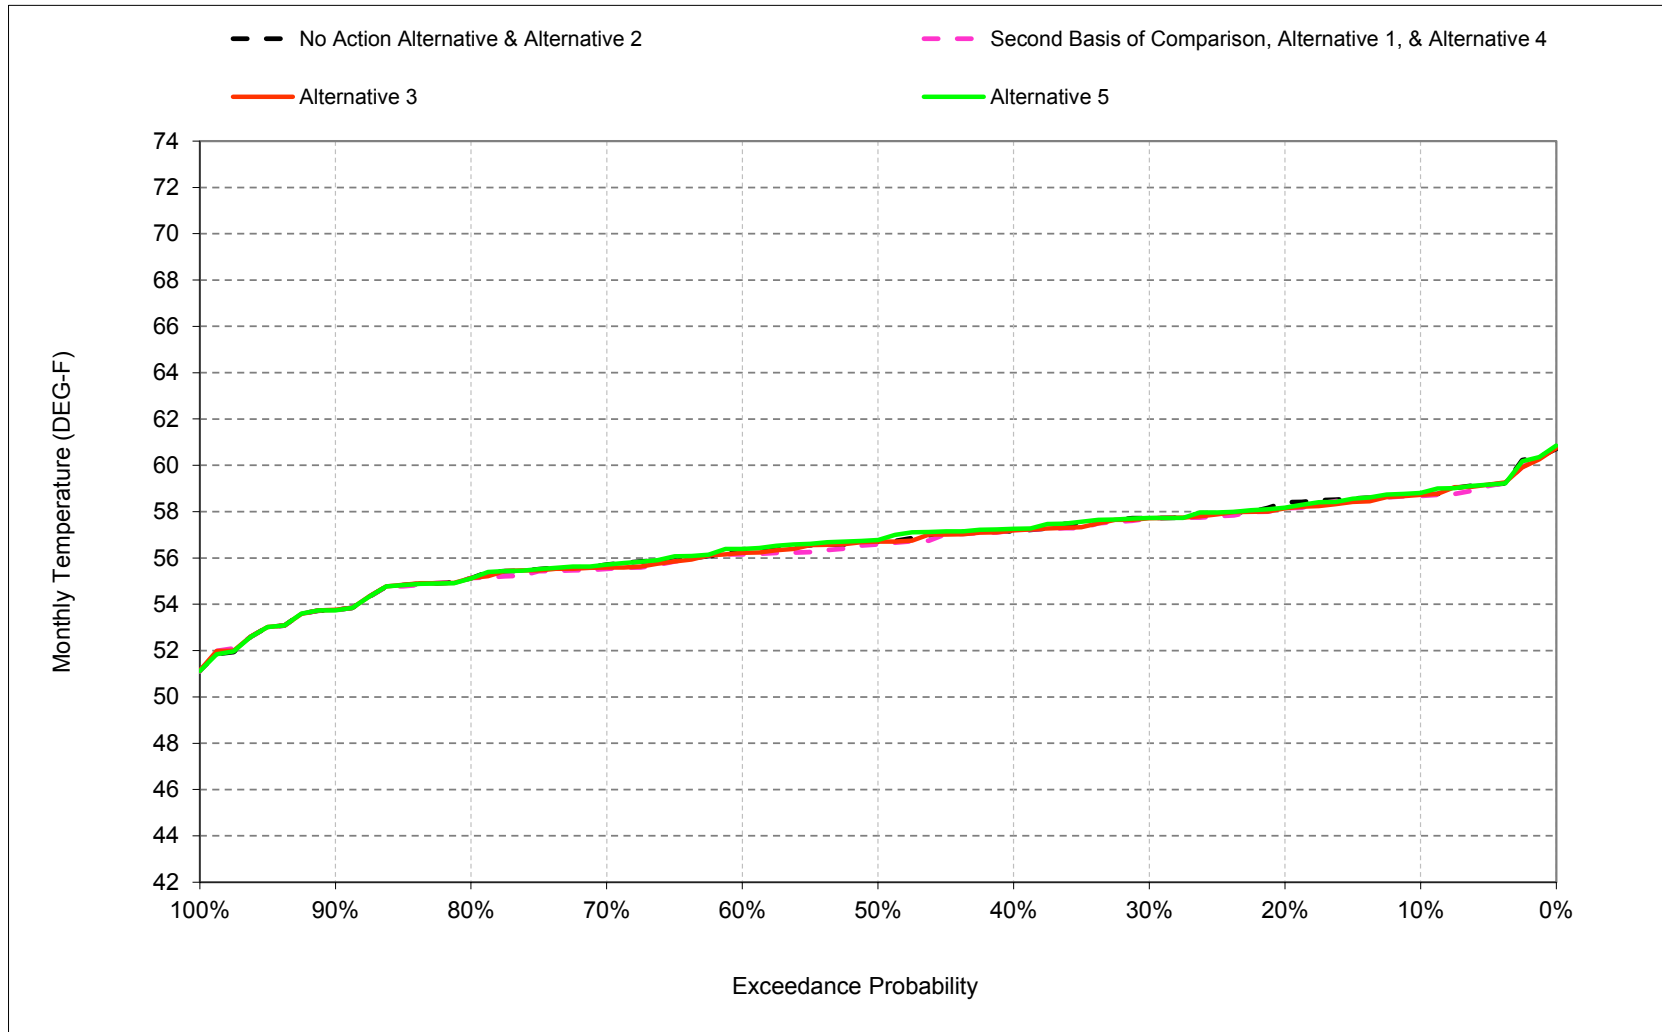


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-10-8. Sacramento River below Hamilton City, May

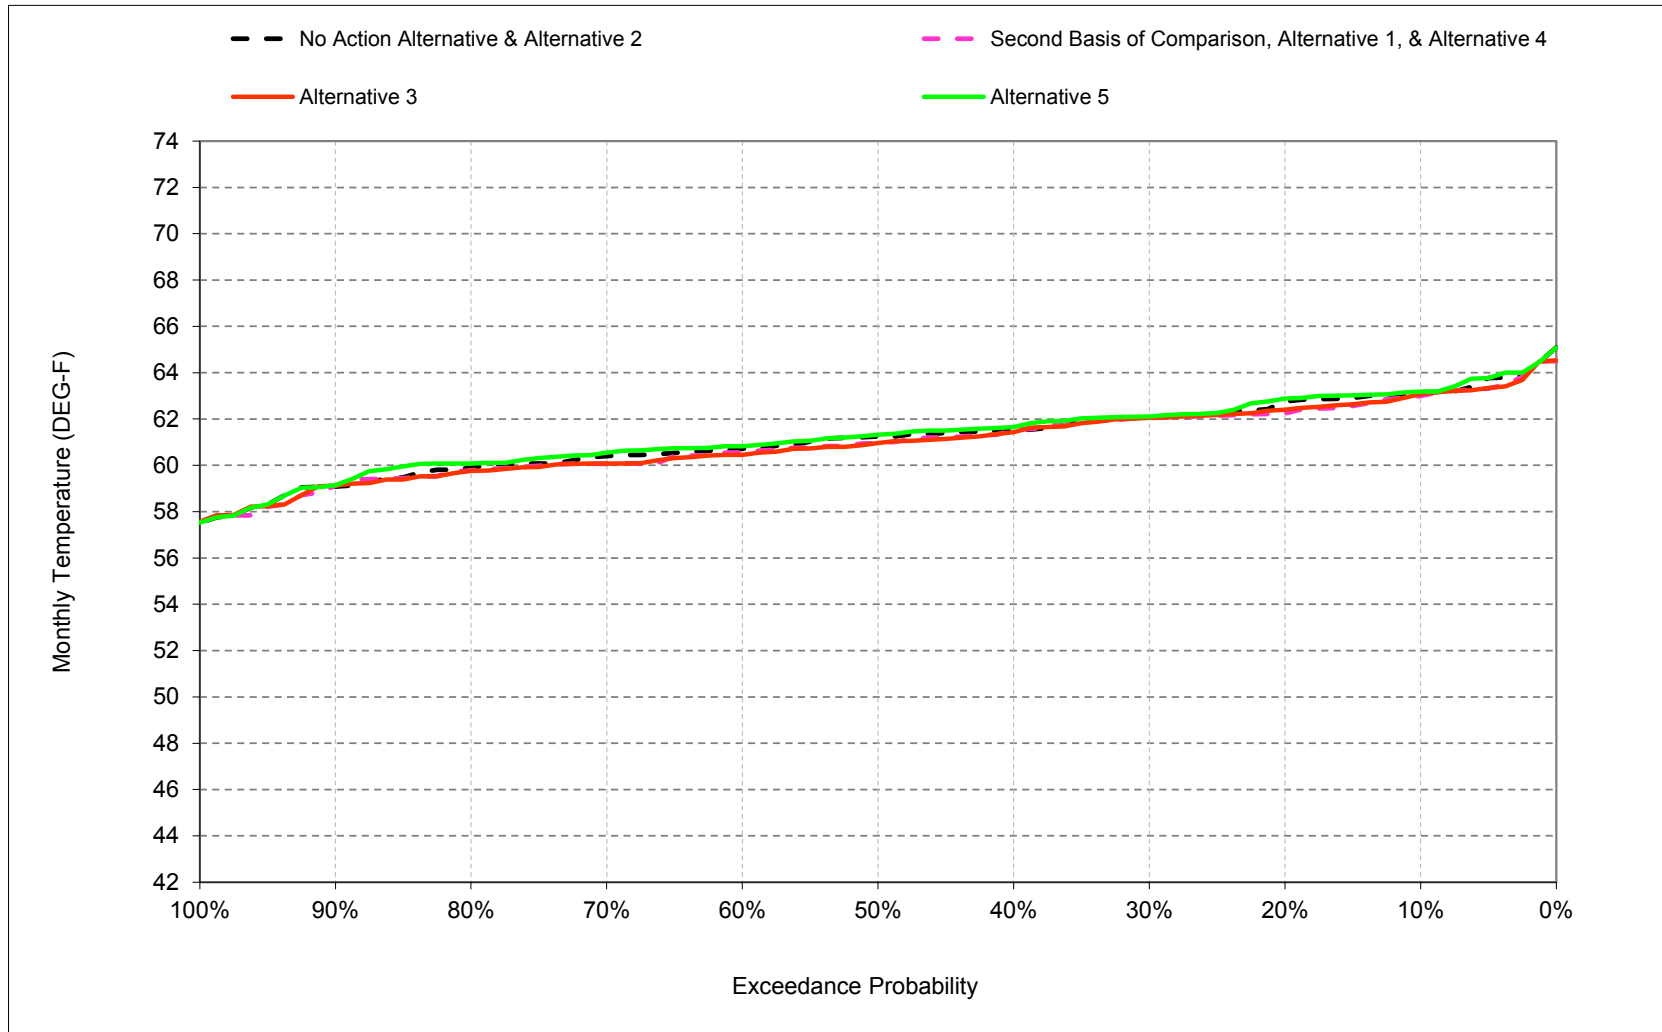


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-10-9. Sacramento River below Hamilton City, June

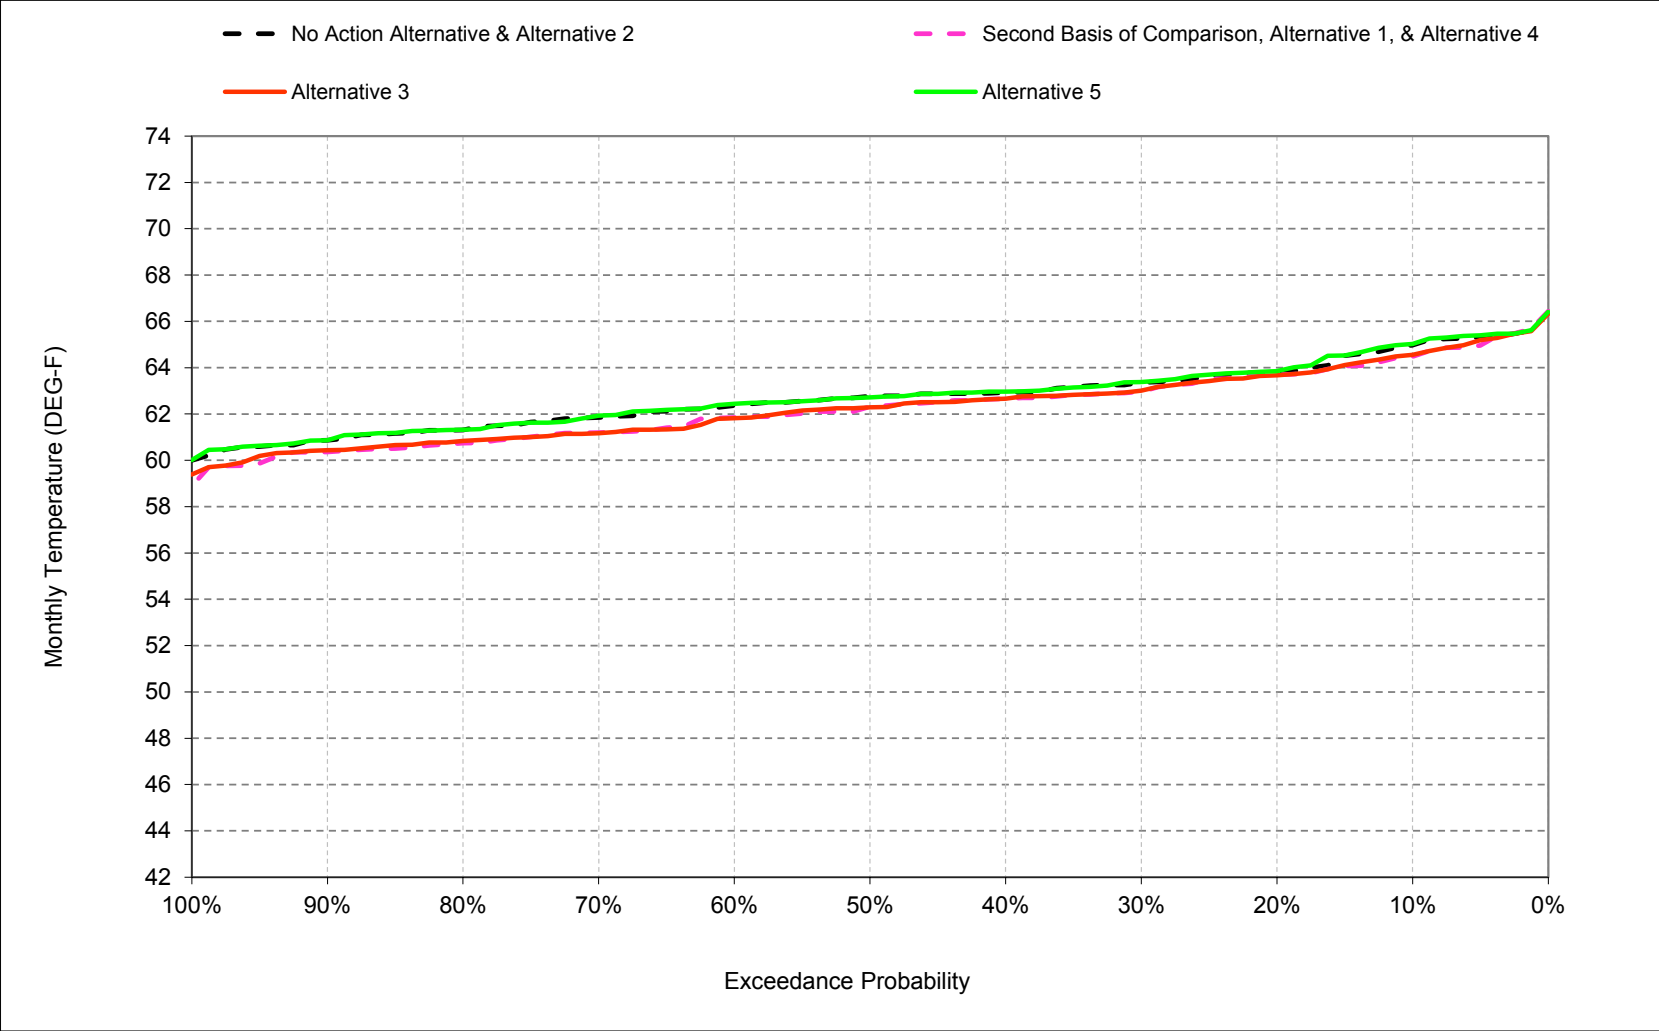


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-10-10. Sacramento River below Hamilton City, July

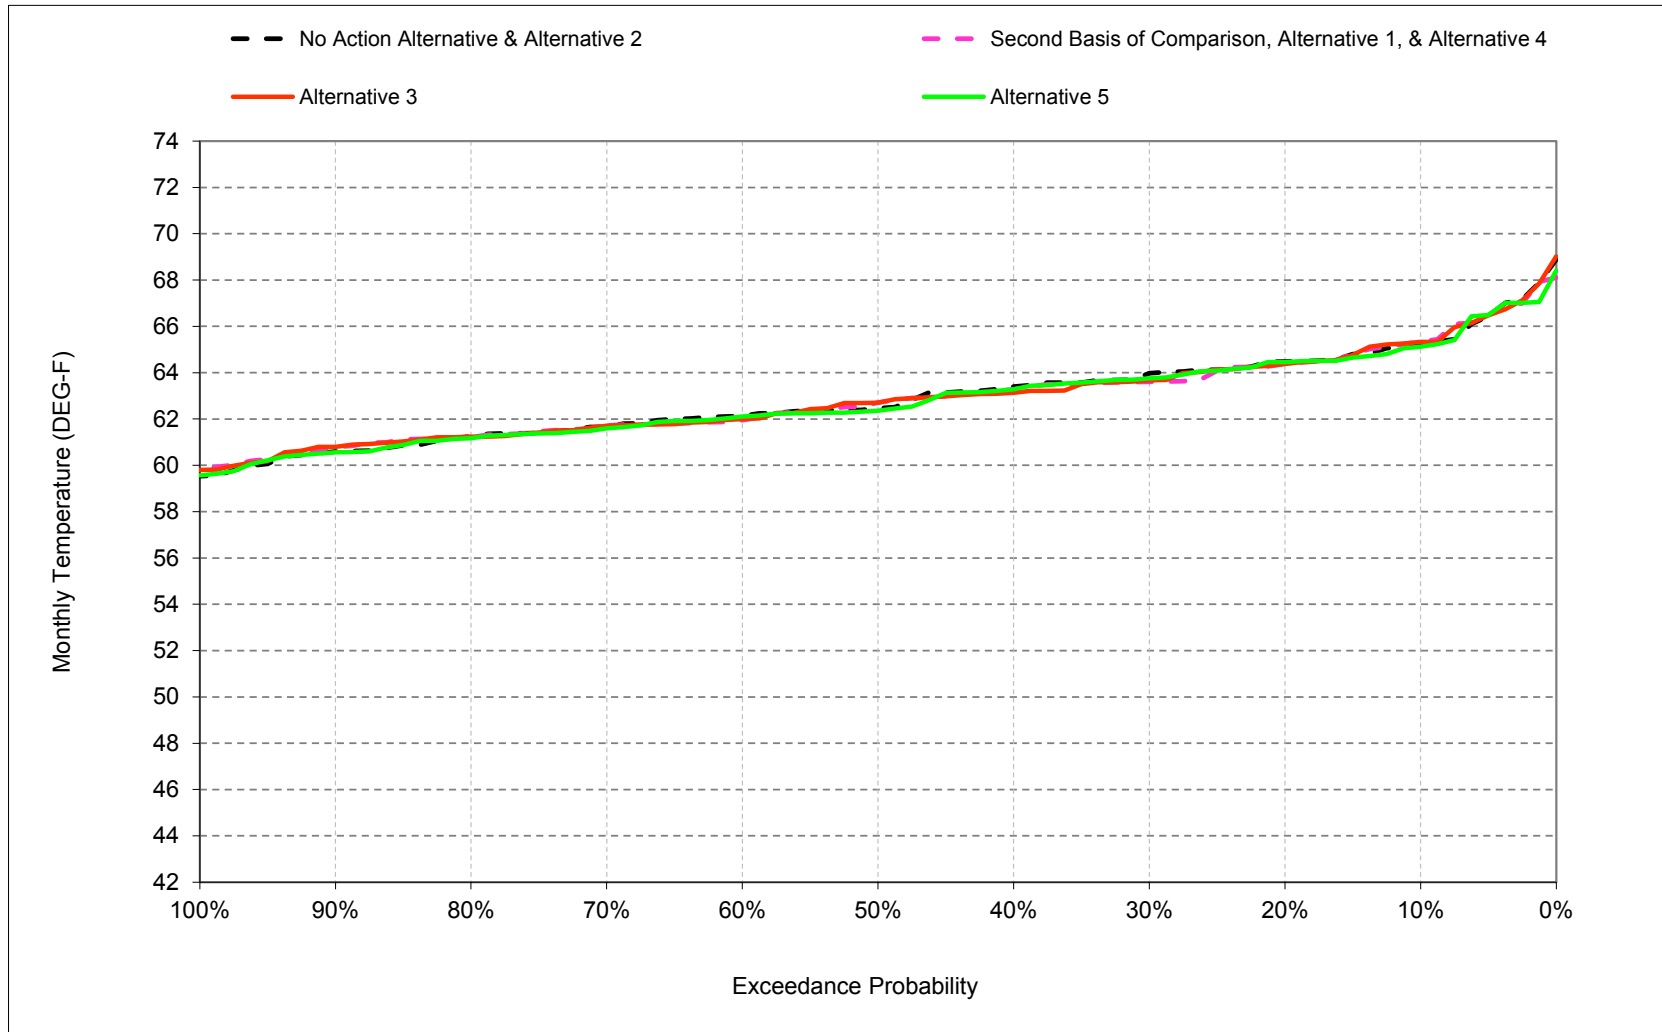


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-10-11. Sacramento River below Hamilton City, August

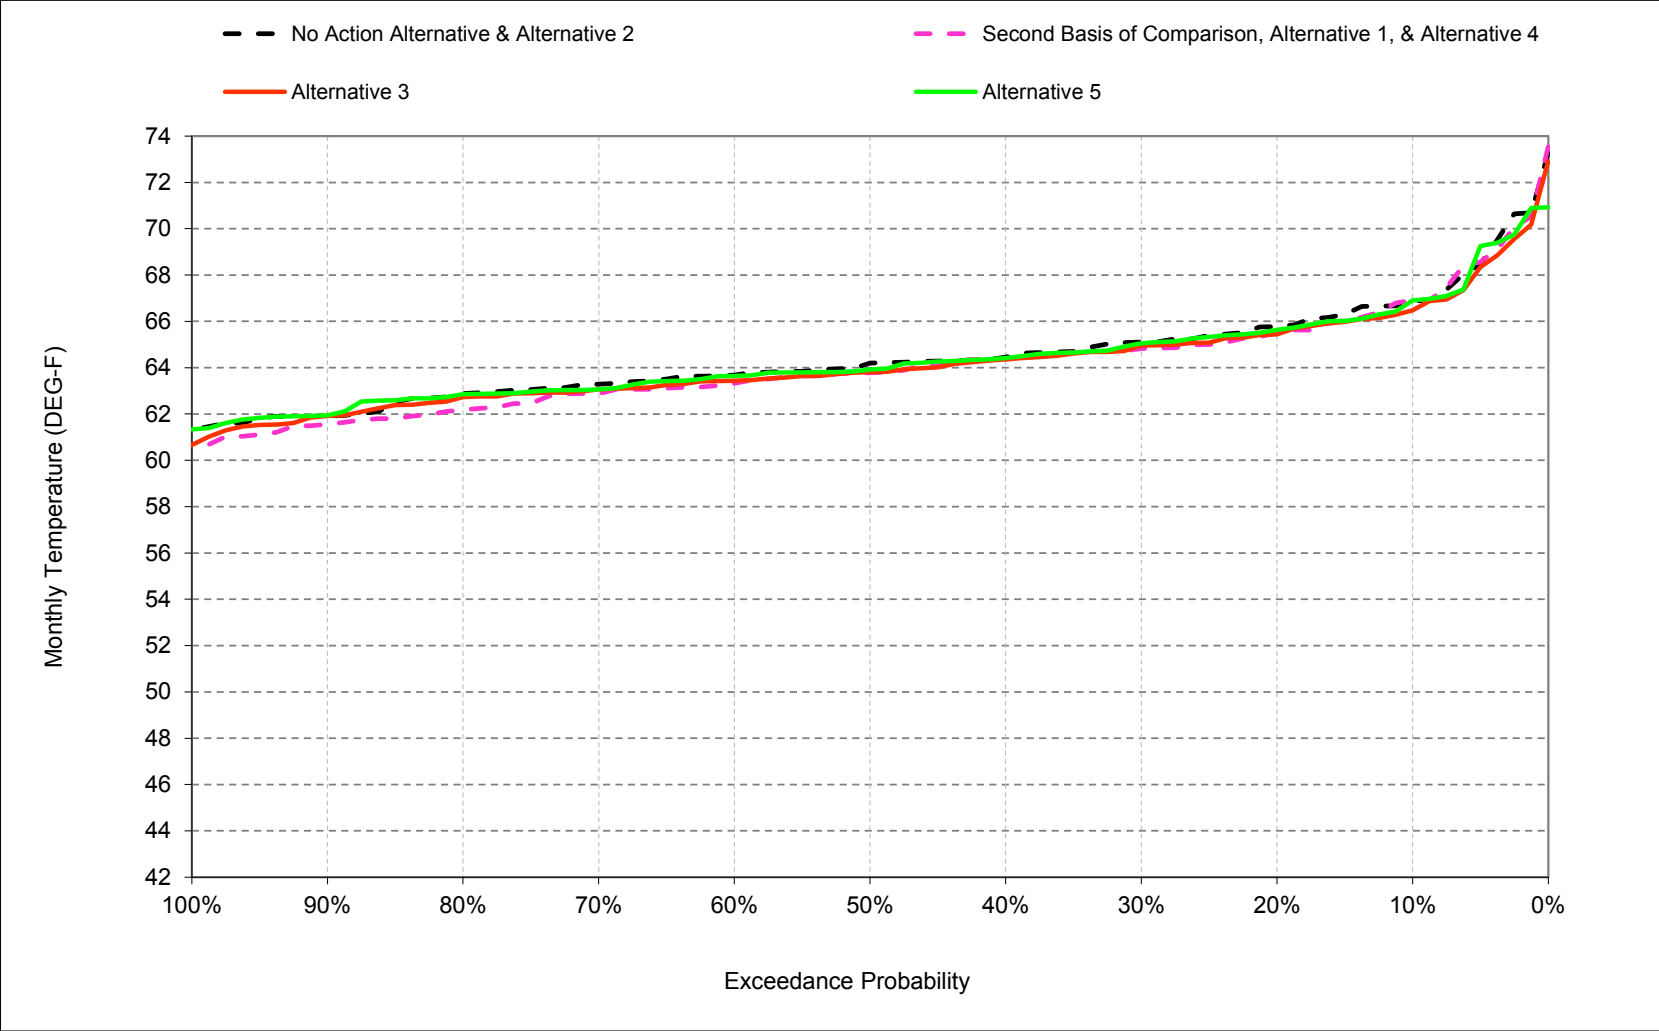

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-10-12. Sacramento River below Hamilton City, September

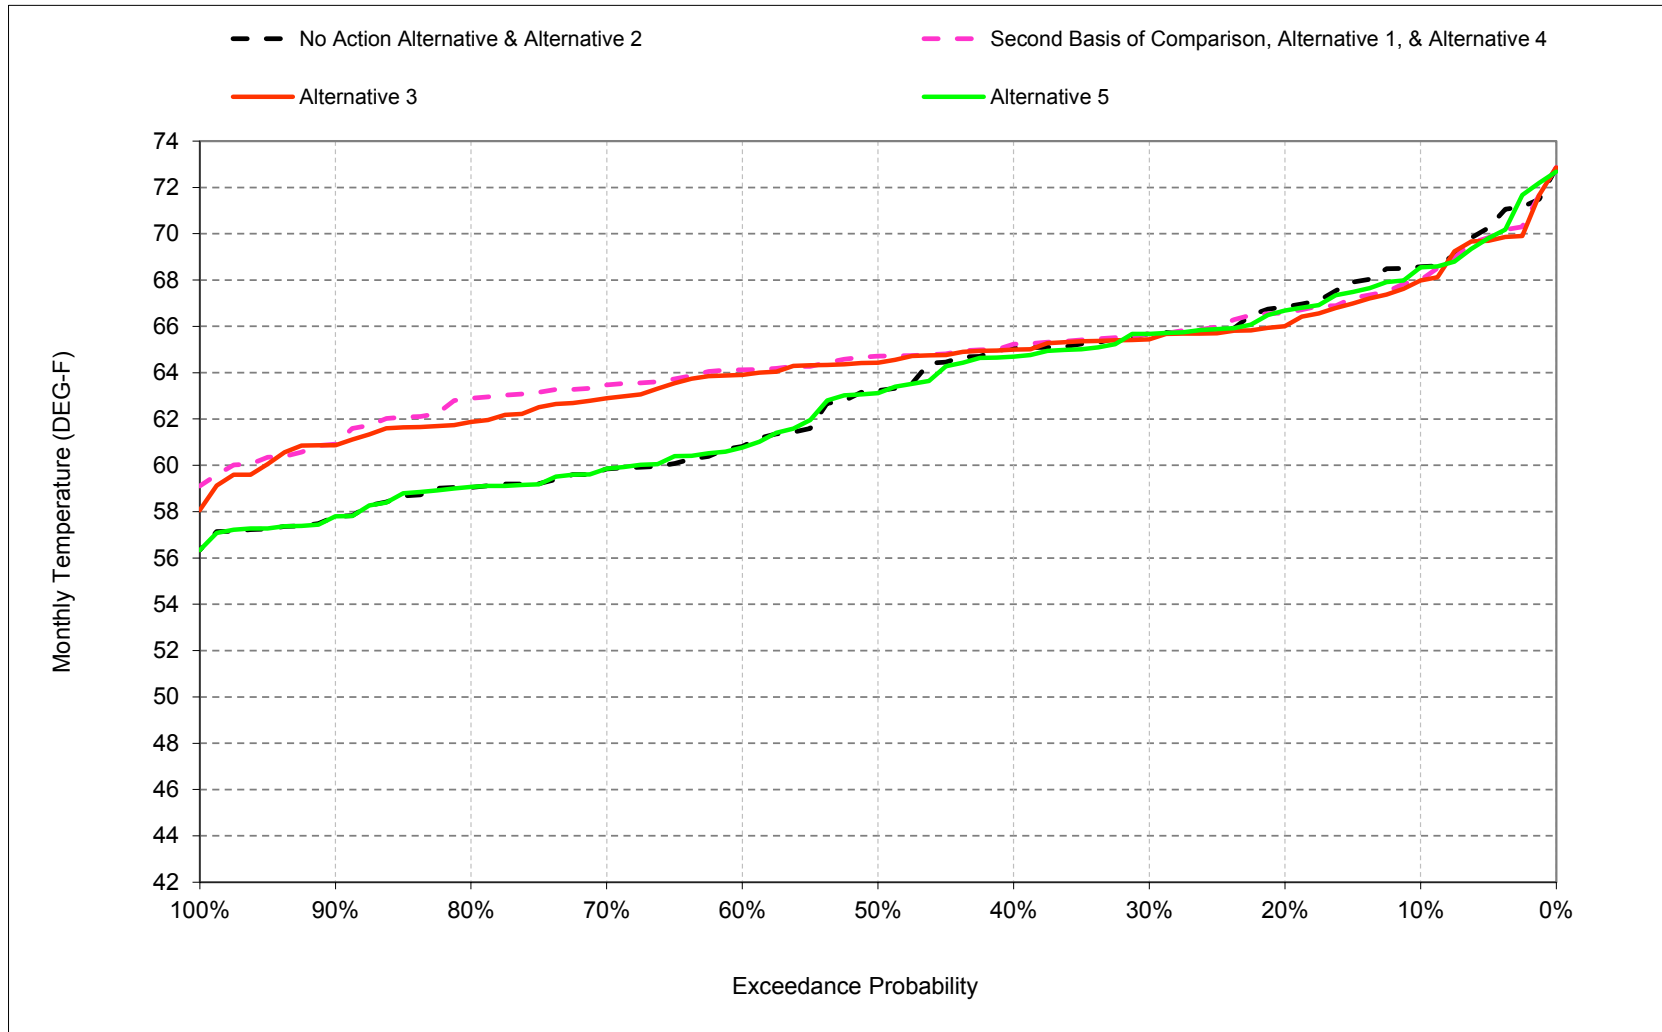

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-10-1. Sacramento River below Hamilton City, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	56	50	48	50	55	59	63	65	65	67	69
20%	60	55	50	48	50	54	58	63	64	64	66	67
30%	60	55	49	47	49	53	58	62	63	64	65	66
40%	59	54	49	47	48	53	57	62	63	63	64	65
50%	59	54	48	47	48	52	57	61	63	62	64	63
60%	58	54	48	46	48	51	56	61	62	62	64	61
70%	58	53	48	46	48	51	56	60	62	62	63	60
80%	58	53	48	46	47	50	55	60	61	61	63	59
90%	57	52	47	46	46	49	54	59	61	61	62	58
Long Term												
Full Simulation Period ^b	59	54	49	47	48	52	57	61	63	63	64	63
Water Year Types ^c												
Wet (32%)	56	52	46	46	47	50	55	60	63	63	64	59
Above Normal (16%)	59	54	49	47	48	51	56	61	62	61	63	61
Below Normal (13%)	58	54	49	47	49	53	57	61	62	62	63	65
Dry (24%)	59	54	49	47	49	53	58	62	62	63	65	66
Critical (15%)	61	55	49	47	50	54	58	62	64	66	68	69

Alternative 1												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	56	50	48	50	55	59	63	64	65	67	68
20%	60	55	49	48	50	54	58	62	64	64	65	67
30%	60	54	49	47	49	53	58	62	63	64	65	66
40%	59	54	49	47	48	52	57	61	63	63	64	65
50%	59	53	48	47	48	52	57	61	62	63	64	65
60%	59	53	48	46	48	51	56	61	62	62	63	64
70%	58	53	48	46	48	51	55	60	61	62	63	63
80%	58	53	48	46	47	50	55	60	61	61	62	63
90%	57	52	47	46	46	49	54	59	60	61	61	61
Long Term												
Full Simulation Period ^b	59	54	49	47	48	52	56	61	62	63	64	65
Water Year Types ^c												
Wet (32%)	56	51	47	46	47	50	55	60	63	63	63	63
Above Normal (16%)	59	54	48	47	48	51	56	61	62	61	62	63
Below Normal (13%)	58	53	48	47	49	53	57	60	61	62	62	64
Dry (24%)	59	54	49	47	49	53	57	61	62	63	65	66
Critical (15%)	61	55	49	47	50	54	58	62	64	66	67	69

Alternative 1 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.4	-0.3	0.2	-0.2	0.1	0.0	-0.1	-0.2	-0.5	0.1	0.0	-0.6
0.2	-0.1	-0.3	-0.2	0.1	-0.1	0.0	-0.2	-0.5	-0.1	-0.1	-0.3	-0.2
0.3	0.1	-0.4	-0.2	0.0	0.0	-0.1	0.0	0.0	-0.4	-0.3	-0.3	0.0
0.4	0.1	-0.7	0.0	0.0	0.0	-0.1	0.0	0.0	-0.3	-0.1	-0.1	0.1
0.5	0.3	-0.4	-0.1	0.0	0.0	-0.2	-0.1	-0.3	-0.5	0.2	-0.3	1.5
0.6	0.4	-0.5	0.0	0.0	0.0	-0.1	-0.1	-0.1	-0.5	-0.2	-0.4	3.2
0.7	0.0	-0.3	0.1	0.0	0.0	-0.1	-0.1	-0.3	-0.6	0.0	-0.4	3.6
0.8	0.0	-0.3	0.1	0.0	0.0	0.0	0.0	-0.1	-0.6	0.0	-0.6	3.8
0.9	0.0	-0.1	0.1	0.0	0.1	0.1	0.0	-0.2	-0.5	0.1	-0.4	3.2
Long Term												
Full Simulation Period ^b	0.0	-0.3	0.0	0.0	0.0	-0.1	-0.1	-0.2	-0.4	0.0	-0.3	1.6
Water Year Types ^c												
Wet (32%)	0.1	-0.3	0.1	0.0	0.0	0.0	0.0	-0.1	-0.1	0.1	-0.6	4.2
Above Normal (16%)	0.1	-0.3	-0.2	0.0	0.0	-0.1	0.0	-0.2	-0.5	0.1	-0.4	2.9
Below Normal (13%)	0.0	-0.4	-0.2	0.0	0.0	-0.3	-0.3	-0.3	-0.6	0.0	-0.6	-0.2
Dry (24%)	0.1	-0.2	-0.1	0.0	0.0	0.0	-0.2	-0.2	-0.6	-0.2	0.2	-0.1
Critical (15%)	-0.2	-0.2	0.0	0.1	0.1	0.0	0.0	0.0	-0.6	0.1	-0.2	-0.6

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-10-2. Sacramento River below Hamilton City, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	56	50	48	50	55	59	63	65	65	67	69
20%	60	55	50	48	50	54	58	63	64	64	66	67
30%	60	55	49	47	49	53	58	62	63	64	65	66
40%	59	54	49	47	48	53	57	62	63	63	64	65
50%	59	54	48	47	48	52	57	61	63	62	64	63
60%	58	54	48	46	48	51	56	61	62	62	64	61
70%	58	53	48	46	48	51	56	60	62	62	63	60
80%	58	53	48	46	47	50	55	60	61	61	63	59
90%	57	52	47	46	46	49	54	59	61	61	62	58
Long Term												
Full Simulation Period ^b	59	54	49	47	48	52	57	61	63	63	64	63
Water Year Types ^c												
Wet (32%)	56	52	46	46	47	50	55	60	63	63	64	59
Above Normal (16%)	59	54	49	47	48	51	56	61	62	61	63	61
Below Normal (13%)	58	54	49	47	49	53	57	61	62	62	63	65
Dry (24%)	59	54	49	47	49	53	58	62	62	63	65	66
Critical (15%)	61	55	49	47	50	54	58	62	64	66	68	69

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	56	50	48	50	55	59	63	65	65	66	68
20%	60	55	49	48	49	54	58	62	64	64	65	66
30%	60	54	49	47	49	53	58	62	63	64	65	65
40%	59	54	49	47	49	52	57	61	63	63	64	65
50%	59	53	48	47	48	52	57	61	62	63	64	64
60%	58	53	48	46	48	51	56	60	62	62	63	64
70%	58	53	48	46	48	51	56	60	61	62	63	63
80%	58	52	48	46	47	50	55	60	61	61	63	62
90%	57	52	47	46	46	49	54	59	60	61	62	61
Long Term												
Full Simulation Period ^b	59	54	49	47	48	52	56	61	62	63	64	64
Water Year Types ^c												
Wet (32%)	56	51	47	46	47	50	55	60	63	63	63	63
Above Normal (16%)	59	54	48	47	48	51	56	61	62	61	63	63
Below Normal (13%)	58	53	48	47	49	53	57	60	61	62	63	63
Dry (24%)	59	54	49	47	49	53	58	61	62	63	65	66
Critical (15%)	61	55	49	47	50	54	58	62	64	66	67	69

Alternative 3 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.7	-0.2	0.2	-0.2	0.1	0.0	0.0	-0.1	-0.4	0.1	-0.4	-0.6
0.2	-0.2	-0.3	-0.2	0.1	-0.1	-0.1	-0.2	-0.3	-0.2	-0.1	-0.3	-0.8
0.3	-0.1	-0.2	-0.2	0.0	0.0	-0.1	0.0	0.0	-0.4	-0.2	-0.2	-0.2
0.4	0.1	-0.6	0.0	0.0	0.0	-0.1	0.0	-0.1	-0.3	-0.2	-0.1	0.0
0.5	0.0	-0.5	0.0	0.1	0.0	-0.2	0.0	-0.3	-0.5	0.3	-0.3	1.3
0.6	0.2	-0.4	0.0	0.0	0.0	0.0	-0.1	-0.2	-0.5	-0.1	-0.2	3.0
0.7	0.0	-0.4	0.1	0.0	0.0	-0.1	-0.1	-0.3	-0.7	0.0	-0.3	3.1
0.8	0.2	-0.4	0.1	0.0	0.0	0.0	0.0	-0.1	-0.5	0.0	-0.2	2.8
0.9	-0.1	-0.1	0.0	0.0	0.1	0.1	0.0	0.0	-0.5	0.3	0.0	3.1
Long Term												
Full Simulation Period ^b	0.0	-0.3	0.0	0.0	0.0	0.0	-0.1	-0.2	-0.4	0.0	-0.3	1.3
Water Year Types ^c												
Wet (32%)	0.1	-0.3	0.1	0.0	0.0	0.0	0.0	-0.1	-0.2	0.0	-0.4	3.9
Above Normal (16%)	0.0	-0.3	-0.2	0.0	0.0	-0.1	0.0	-0.3	-0.4	0.1	-0.1	2.9
Below Normal (13%)	0.0	-0.4	-0.2	0.0	0.0	-0.3	-0.2	-0.3	-0.5	-0.1	-0.2	-1.4
Dry (24%)	-0.1	-0.3	-0.1	0.0	0.0	0.0	-0.1	-0.2	-0.6	-0.2	-0.2	-0.2
Critical (15%)	-0.3	-0.2	0.0	0.1	0.0	0.0	0.0	0.0	-0.5	0.3	-0.4	-0.7

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-10-3. Sacramento River below Hamilton City, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	56	50	48	50	55	59	63	65	65	67	69
20%	60	55	50	48	50	54	58	63	64	64	66	67
30%	60	55	49	47	49	53	58	62	63	64	65	66
40%	59	54	49	47	48	53	57	62	63	63	64	65
50%	59	54	48	47	48	52	57	61	63	62	64	63
60%	58	54	48	46	48	51	56	61	62	62	64	61
70%	58	53	48	46	48	51	56	60	62	62	63	60
80%	58	53	48	46	47	50	55	60	61	61	63	59
90%	57	52	47	46	46	49	54	59	61	61	62	58
Long Term												
Full Simulation Period ^b	59	54	49	47	48	52	57	61	63	63	64	63
Water Year Types ^c												
Wet (32%)	56	52	46	46	47	50	55	60	63	63	64	59
Above Normal (16%)	59	54	49	47	48	51	56	61	62	61	63	61
Below Normal (13%)	58	54	49	47	49	53	57	61	62	62	63	65
Dry (24%)	59	54	49	47	49	53	58	62	62	63	65	66
Critical (15%)	61	55	49	47	50	54	58	62	64	66	68	69

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	56	50	48	50	55	59	63	65	65	67	68
20%	60	55	50	48	50	54	58	63	64	64	66	67
30%	60	55	49	47	49	53	58	62	63	64	65	66
40%	59	54	49	47	48	53	57	62	63	63	64	65
50%	58	54	48	47	48	52	57	61	63	62	64	63
60%	58	53	48	46	48	51	56	61	62	62	64	61
70%	58	53	48	46	48	51	56	60	62	62	63	60
80%	58	53	48	46	47	50	55	60	61	61	63	59
90%	57	52	47	46	46	49	54	59	61	61	62	58
Long Term												
Full Simulation Period ^b	59	54	49	47	48	52	57	61	63	63	64	63
Water Year Types ^c												
Wet (32%)	56	52	46	46	47	50	55	60	63	63	64	59
Above Normal (16%)	59	54	49	47	48	51	56	61	62	61	63	61
Below Normal (13%)	58	54	49	47	49	53	57	61	62	62	63	64
Dry (24%)	59	54	49	47	49	53	58	62	62	63	65	66
Critical (15%)	61	55	49	47	50	54	58	63	64	65	67	69

Alternative 5 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.0	-0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.1	-0.1	0.0	-0.1
0.2	0.0	0.0	0.0	0.1	0.0	0.0	-0.2	0.2	0.0	0.0	-0.2	-0.2
0.3	0.0	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.0
0.4	0.0	-0.1	0.0	0.0	0.0	0.0	0.1	0.1	0.0	-0.1	0.0	-0.3
0.5	-0.2	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	-0.1	-0.2	-0.1
0.6	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	-0.1	0.0	-0.1
0.7	-0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	-0.1	-0.2	0.0
0.8	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.0	0.0	0.0	0.0
0.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	-0.1	-0.1	-0.1
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.1
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.2	-0.2
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.3	0.0	-0.1	-0.3	-0.2
Critical (15%)	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.2	0.2	-0.2	-0.3	-0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-10-4. Sacramento River below Hamilton City, Monthly Temperature

Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	56	50	48	50	55	59	63	64	65	67	68
20%	60	55	49	48	50	54	58	62	64	64	65	67
30%	60	54	49	47	49	53	58	62	63	64	65	66
40%	59	54	49	47	48	52	57	61	63	63	64	65
50%	59	53	48	47	48	52	57	61	62	63	64	65
60%	59	53	48	46	48	51	56	61	62	62	63	64
70%	58	53	48	46	48	51	55	60	61	62	63	63
80%	58	53	48	46	47	50	55	60	61	61	62	63
90%	57	52	47	46	46	49	54	59	60	61	61	61
Long Term												
Full Simulation Period ^b	59	54	49	47	48	52	56	61	62	63	64	65
Water Year Types ^c												
Wet (32%)	56	51	47	46	47	50	55	60	63	63	63	63
Above Normal (16%)	59	54	48	47	48	51	56	61	62	61	62	63
Below Normal (13%)	58	53	48	47	49	53	57	60	61	62	62	64
Dry (24%)	59	54	49	47	49	53	57	61	62	63	65	66
Critical (15%)	61	55	49	47	50	54	58	62	64	66	67	69

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	56	50	48	50	55	59	63	65	65	67	69
20%	60	55	50	48	50	54	58	63	64	64	66	67
30%	60	55	49	47	49	53	58	62	63	64	65	66
40%	59	54	49	47	48	53	57	62	63	63	64	65
50%	59	54	48	47	48	52	57	61	63	62	64	63
60%	58	54	48	46	48	51	56	61	62	62	64	61
70%	58	53	48	46	48	51	56	60	62	62	63	60
80%	58	53	48	46	47	50	55	60	61	61	63	59
90%	57	52	47	46	46	49	54	59	61	61	62	58
Long Term												
Full Simulation Period ^b	59	54	49	47	48	52	57	61	63	63	64	63
Water Year Types ^c												
Wet (32%)	56	52	46	46	47	50	55	60	63	63	64	59
Above Normal (16%)	59	54	49	47	48	51	56	61	62	61	63	61
Below Normal (13%)	58	54	49	47	49	53	57	61	62	62	63	65
Dry (24%)	59	54	49	47	49	53	58	62	62	63	65	66
Critical (15%)	61	55	49	47	50	54	58	62	64	66	68	69

No Action Alternative minus Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.4	0.3	-0.2	0.2	-0.1	0.0	0.1	0.2	0.5	-0.1	0.0	0.6
0.2	0.1	0.3	0.2	-0.1	0.1	0.0	0.2	0.5	0.1	0.1	0.3	0.2
0.3	-0.1	0.4	0.2	0.0	0.0	0.1	0.0	0.0	0.4	0.3	0.3	0.0
0.4	-0.1	0.7	0.0	0.0	0.0	0.1	0.0	0.0	0.3	0.1	0.1	-0.1
0.5	-0.3	0.4	0.1	0.0	0.0	0.2	0.1	0.3	0.5	-0.2	0.3	-1.5
0.6	-0.4	0.5	0.0	0.0	0.0	0.1	0.1	0.1	0.5	0.2	0.4	-3.2
0.7	0.0	0.3	-0.1	0.0	0.0	0.1	0.1	0.3	0.6	0.0	0.4	-3.6
0.8	0.0	0.3	-0.1	0.0	0.0	0.0	0.0	0.1	0.6	0.0	0.6	-3.8
0.9	0.0	0.1	-0.1	0.0	-0.1	-0.1	0.0	0.2	0.5	-0.1	0.4	-3.2
Long Term												
Full Simulation Period ^b	0.0	0.3	0.0	0.0	0.0	0.1	0.1	0.2	0.4	0.0	0.3	-1.6
Water Year Types ^c												
Wet (32%)	-0.1	0.3	-0.1	0.0	0.0	0.0	0.0	0.1	0.1	-0.1	0.6	-4.2
Above Normal (16%)	-0.1	0.3	0.2	0.0	0.0	0.1	0.0	0.2	0.5	-0.1	0.4	-2.9
Below Normal (13%)	0.0	0.4	0.2	0.0	0.0	0.3	0.3	0.3	0.6	0.0	0.6	0.2
Dry (24%)	-0.1	0.2	0.1	0.0	0.0	0.0	0.2	0.2	0.6	0.2	-0.2	0.1
Critical (15%)	0.2	0.2	0.0	-0.1	-0.1	0.0	0.0	0.0	0.6	-0.1	0.2	0.6

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-10-5. Sacramento River below Hamilton City, Monthly Temperature

Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	62	56	50	48	50	55	59	63	64	65	67	68
20%	60	55	49	48	50	54	58	62	64	64	65	67
30%	60	54	49	47	49	53	58	62	63	64	65	66
40%	59	54	49	47	48	52	57	61	63	63	64	65
50%	59	53	48	47	48	52	57	61	62	63	64	65
60%	59	53	48	46	48	51	56	61	62	62	63	64
70%	58	53	48	46	48	51	55	60	61	62	63	63
80%	58	53	48	46	47	50	55	60	61	61	62	63
90%	57	52	47	46	46	49	54	59	60	61	61	61
Long Term												
Full Simulation Period ^b	59	54	49	47	48	52	56	61	62	63	64	65
Water Year Types^c												
Wet (32%)	56	51	47	46	47	50	55	60	63	63	63	63
Above Normal (16%)	59	54	48	47	48	51	56	61	62	61	62	63
Below Normal (13%)	58	53	48	47	49	53	57	60	61	62	62	64
Dry (24%)	59	54	49	47	49	53	57	61	62	63	65	66
Critical (15%)	61	55	49	47	50	54	58	62	64	66	67	69

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	61	56	50	48	50	55	59	63	65	65	66	68
20%	60	55	49	48	49	54	58	62	64	64	65	66
30%	60	54	49	47	49	53	58	62	63	64	65	65
40%	59	54	49	47	49	52	57	61	63	63	64	65
50%	59	53	48	47	48	52	57	61	62	63	64	64
60%	58	53	48	46	48	51	56	60	62	62	63	64
70%	58	53	48	46	48	51	56	60	61	62	63	63
80%	58	52	48	46	47	50	55	60	61	61	63	62
90%	57	52	47	46	46	49	54	59	60	61	62	61
Long Term												
Full Simulation Period ^b	59	54	49	47	48	52	56	61	62	63	64	64
Water Year Types^c												
Wet (32%)	56	51	47	46	47	50	55	60	63	63	63	63
Above Normal (16%)	59	54	48	47	48	51	56	61	62	61	63	63
Below Normal (13%)	58	53	48	47	49	53	57	60	61	62	63	63
Dry (24%)	59	54	49	47	49	53	58	61	62	63	65	66
Critical (15%)	61	55	49	47	50	54	58	62	64	66	67	69

Alternative 3 minus Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
0.1	-0.3	0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	-0.5	0.0
0.2	-0.2	0.0	0.0	0.0	-0.1	0.0	0.0	0.2	0.0	0.0	0.0	-0.6
0.3	-0.1	0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	-0.2
0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	-0.1	0.0	-0.2
0.5	-0.2	-0.1	0.1	0.0	0.1	0.0	0.1	0.0	0.1	0.1	0.0	-0.2
0.6	-0.2	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.1	0.2	-0.2
0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.1	-0.6
0.8	0.2	-0.1	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.0	0.4	-1.0
0.9	-0.1	0.0	-0.1	0.0	0.0	0.0	0.0	0.2	0.1	0.1	0.4	-0.1
Long Term												
Full Simulation Period ^b	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.3
Water Year Types^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.3	-0.3
Above Normal (16%)	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.0	0.3	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.2	0.0	0.4	-1.2
Dry (24%)	-0.2	-0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	-0.4	-0.1
Critical (15%)	-0.1	0.0	0.0	0.0	-0.1	0.0	0.1	0.0	0.1	0.2	-0.2	-0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-10-6. Sacramento River below Hamilton City, Monthly Temperature

Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	62	56	50	48	50	55	59	63	64	65	67	68
20%	60	55	49	48	50	54	58	62	64	64	65	67
30%	60	54	49	47	49	53	58	62	63	64	65	66
40%	59	54	49	47	48	52	57	61	63	63	64	65
50%	59	53	48	47	48	52	57	61	62	63	64	65
60%	59	53	48	46	48	51	56	61	62	62	63	64
70%	58	53	48	46	48	51	55	60	61	62	63	63
80%	58	53	48	46	47	50	55	60	61	61	62	63
90%	57	52	47	46	46	49	54	59	60	61	61	61
Long Term												
Full Simulation Period ^b	59	54	49	47	48	52	56	61	62	63	64	65
Water Year Types^c												
Wet (32%)	56	51	47	46	47	50	55	60	63	63	63	63
Above Normal (16%)	59	54	48	47	48	51	56	61	62	61	62	63
Below Normal (13%)	58	53	48	47	49	53	57	60	61	62	62	64
Dry (24%)	59	54	49	47	49	53	57	61	62	63	65	66
Critical (15%)	61	55	49	47	50	54	58	62	64	66	67	69

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	62	56	50	48	50	55	59	63	65	65	67	68
20%	60	55	50	48	50	54	58	63	64	64	66	67
30%	60	55	49	47	49	53	58	62	63	64	65	66
40%	59	54	49	47	48	53	57	62	63	63	64	65
50%	58	54	48	47	48	52	57	61	63	62	64	63
60%	58	53	48	46	48	51	56	61	62	62	64	61
70%	58	53	48	46	48	51	56	60	62	62	63	60
80%	58	53	48	46	47	50	55	60	61	61	63	59
90%	57	52	47	46	46	49	54	59	61	61	62	58
Long Term												
Full Simulation Period ^b	59	54	49	47	48	52	57	61	63	63	64	63
Water Year Types^c												
Wet (32%)	56	52	46	46	47	50	55	60	63	63	64	59
Above Normal (16%)	59	54	49	47	48	51	56	61	62	61	63	61
Below Normal (13%)	58	54	49	47	49	53	57	61	62	62	63	64
Dry (24%)	59	54	49	47	49	53	58	62	62	63	65	66
Critical (15%)	61	55	49	47	50	54	58	63	64	65	67	69

Alternative 5 minus Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
0.1	0.4	0.2	-0.2	0.2	0.0	0.0	0.1	0.2	0.5	-0.2	-0.1	0.5
0.2	0.0	0.3	0.2	-0.1	0.1	0.0	0.0	0.6	0.1	0.1	0.1	0.1
0.3	-0.1	0.3	0.1	0.0	0.0	0.1	0.0	0.1	0.4	0.1	0.2	0.0
0.4	-0.2	0.6	0.0	0.0	0.0	0.1	0.1	0.2	0.3	0.0	0.0	-0.5
0.5	-0.5	0.4	0.1	0.0	0.0	0.2	0.2	0.3	0.5	-0.3	0.1	-1.6
0.6	-0.3	0.4	0.0	0.0	0.0	0.1	0.2	0.3	0.6	0.2	0.4	-3.3
0.7	-0.2	0.4	-0.1	0.0	0.0	0.1	0.2	0.4	0.7	-0.1	0.2	-3.6
0.8	0.0	0.2	-0.1	0.0	0.0	0.0	0.0	0.3	0.6	0.0	0.6	-3.8
0.9	-0.1	0.1	-0.1	0.0	-0.1	-0.1	0.0	0.2	0.5	-0.1	0.4	-3.2
Long Term												
Full Simulation Period ^b	0.0	0.3	0.0	0.0	0.0	0.0	0.1	0.3	0.5	-0.1	0.2	-1.7
Water Year Types^c												
Wet (32%)	-0.1	0.3	-0.2	0.0	0.0	0.0	0.0	0.1	0.1	-0.1	0.6	-4.1
Above Normal (16%)	-0.1	0.3	0.2	0.0	0.0	0.1	0.0	0.3	0.6	-0.1	0.5	-2.8
Below Normal (13%)	0.0	0.4	0.2	0.0	0.0	0.3	0.2	0.4	0.7	0.0	0.8	0.0
Dry (24%)	0.0	0.2	0.1	0.0	0.0	0.0	0.2	0.5	0.6	0.1	-0.5	-0.1
Critical (15%)	0.1	0.2	0.0	-0.1	-0.1	0.0	0.2	0.3	0.8	-0.3	-0.2	0.5

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


B.11. Sacramento River at Knights Landing Temperature

Figure B-11-1. Sacramento River at Knights Landing, October

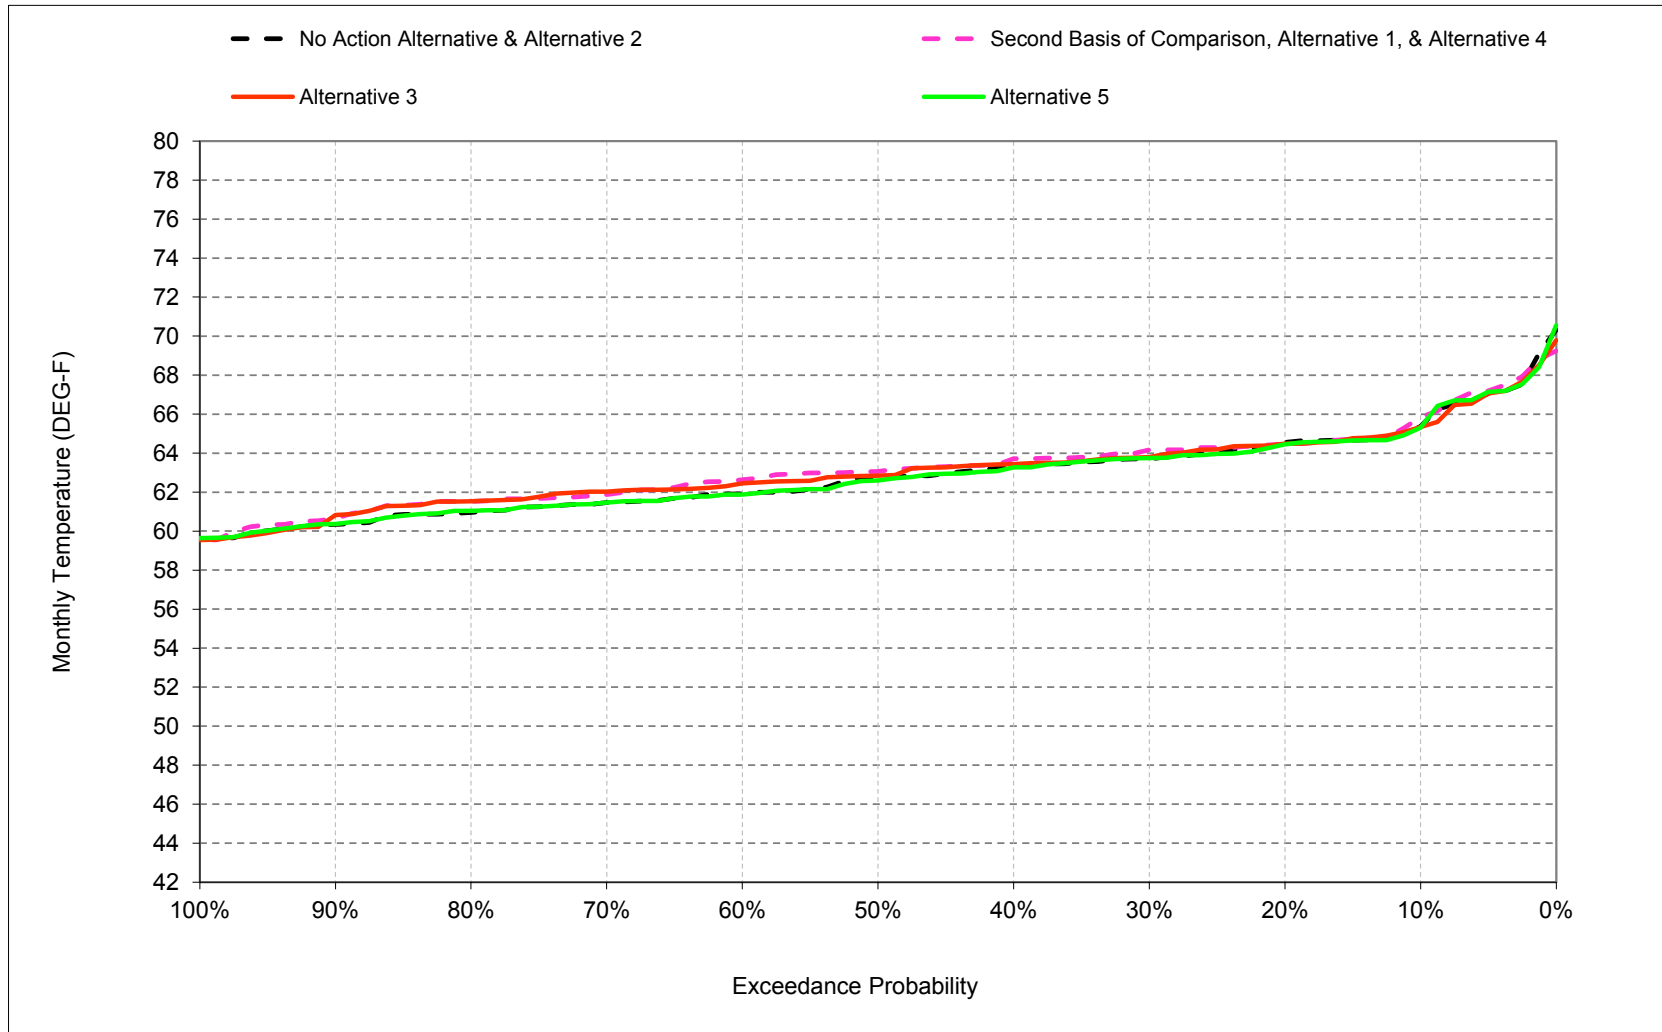


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-11-2. Sacramento River at Knights Landing, November

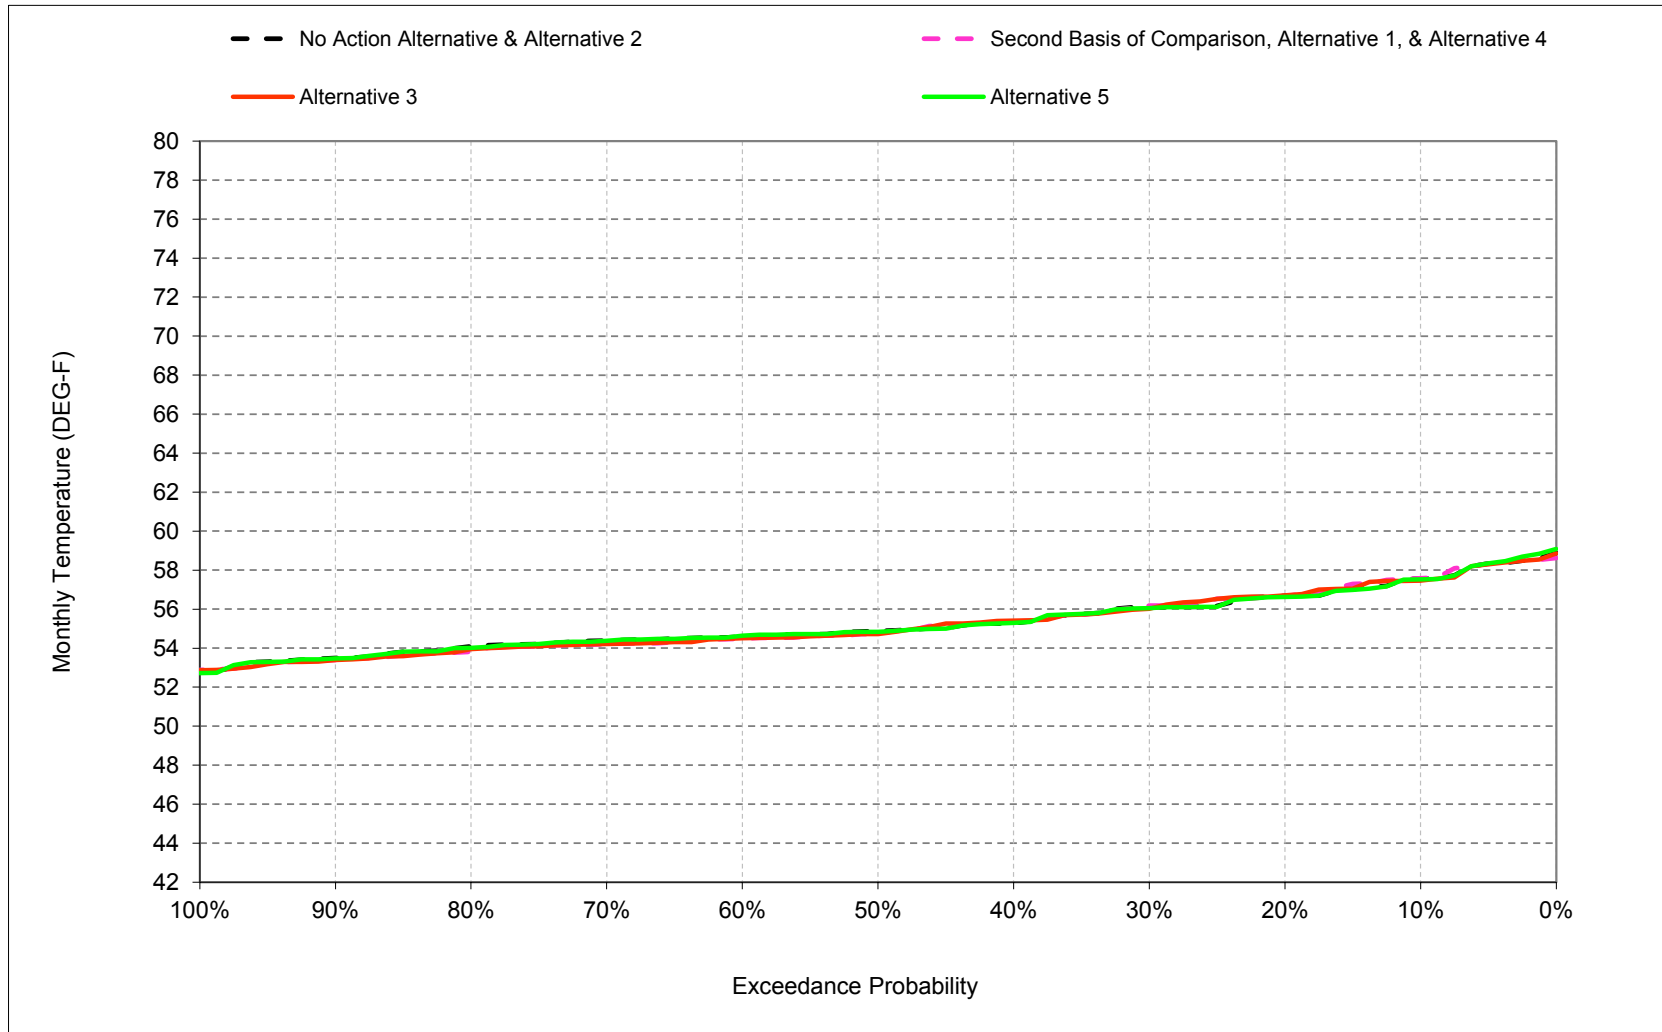


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-11-3. Sacramento River at Knights Landing, December

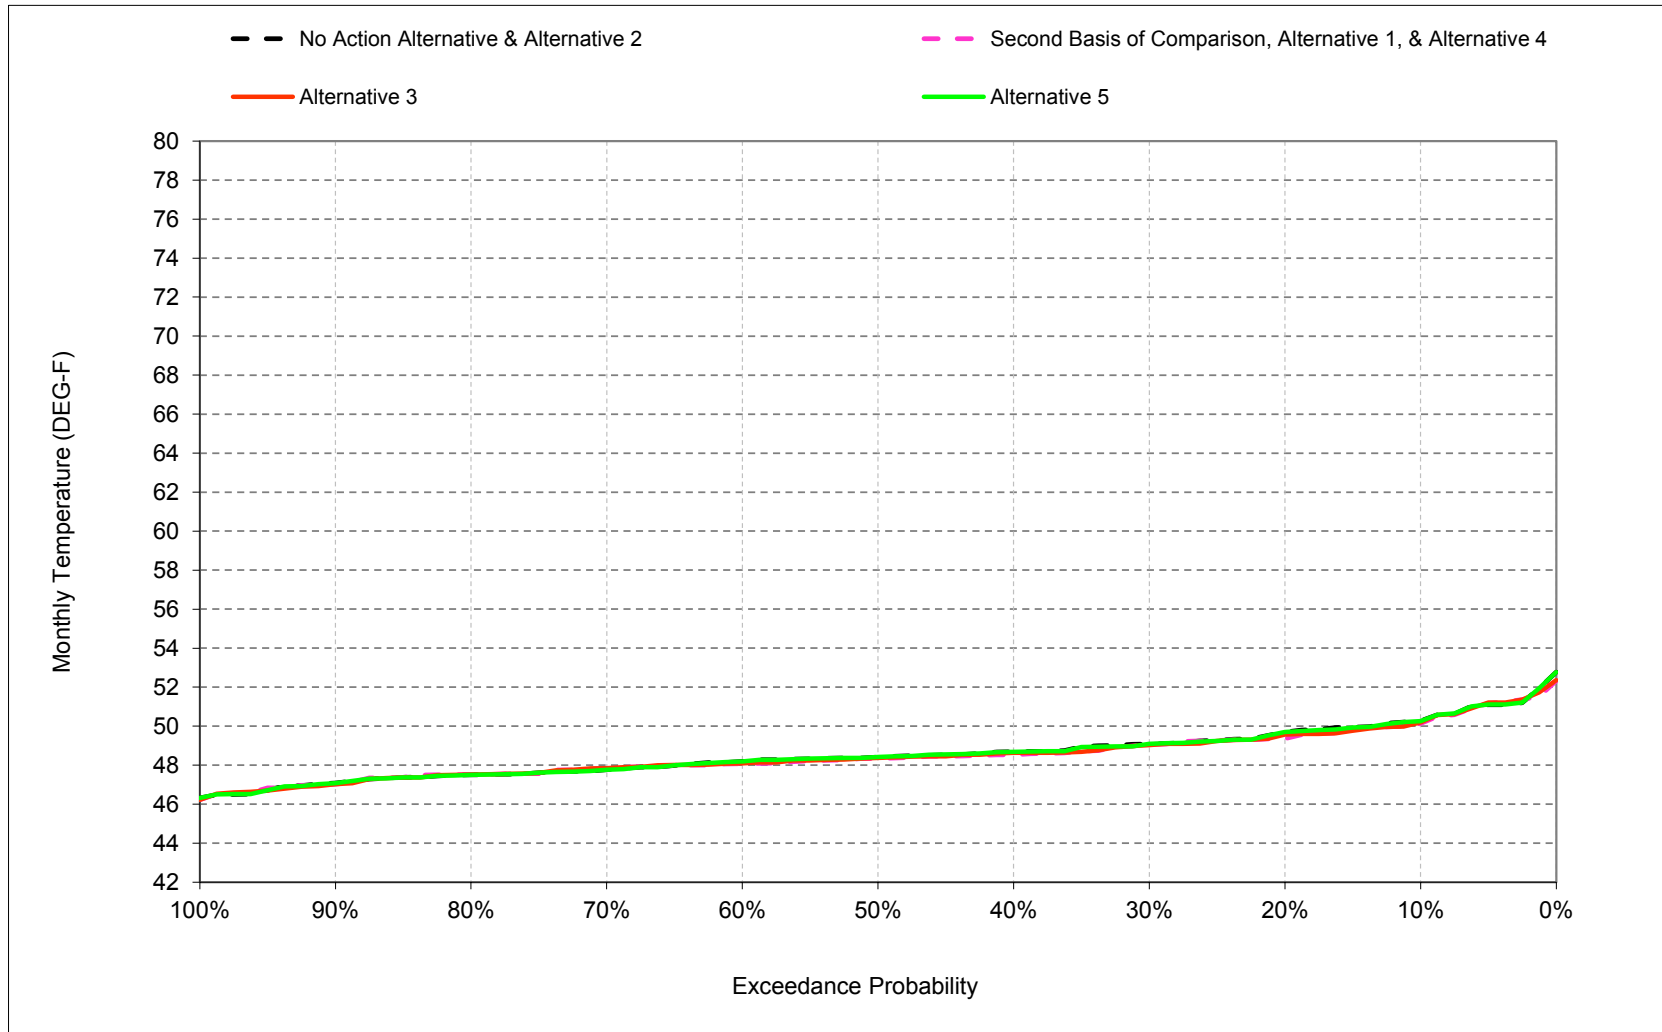


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-11-4. Sacramento River at Knights Landing, January

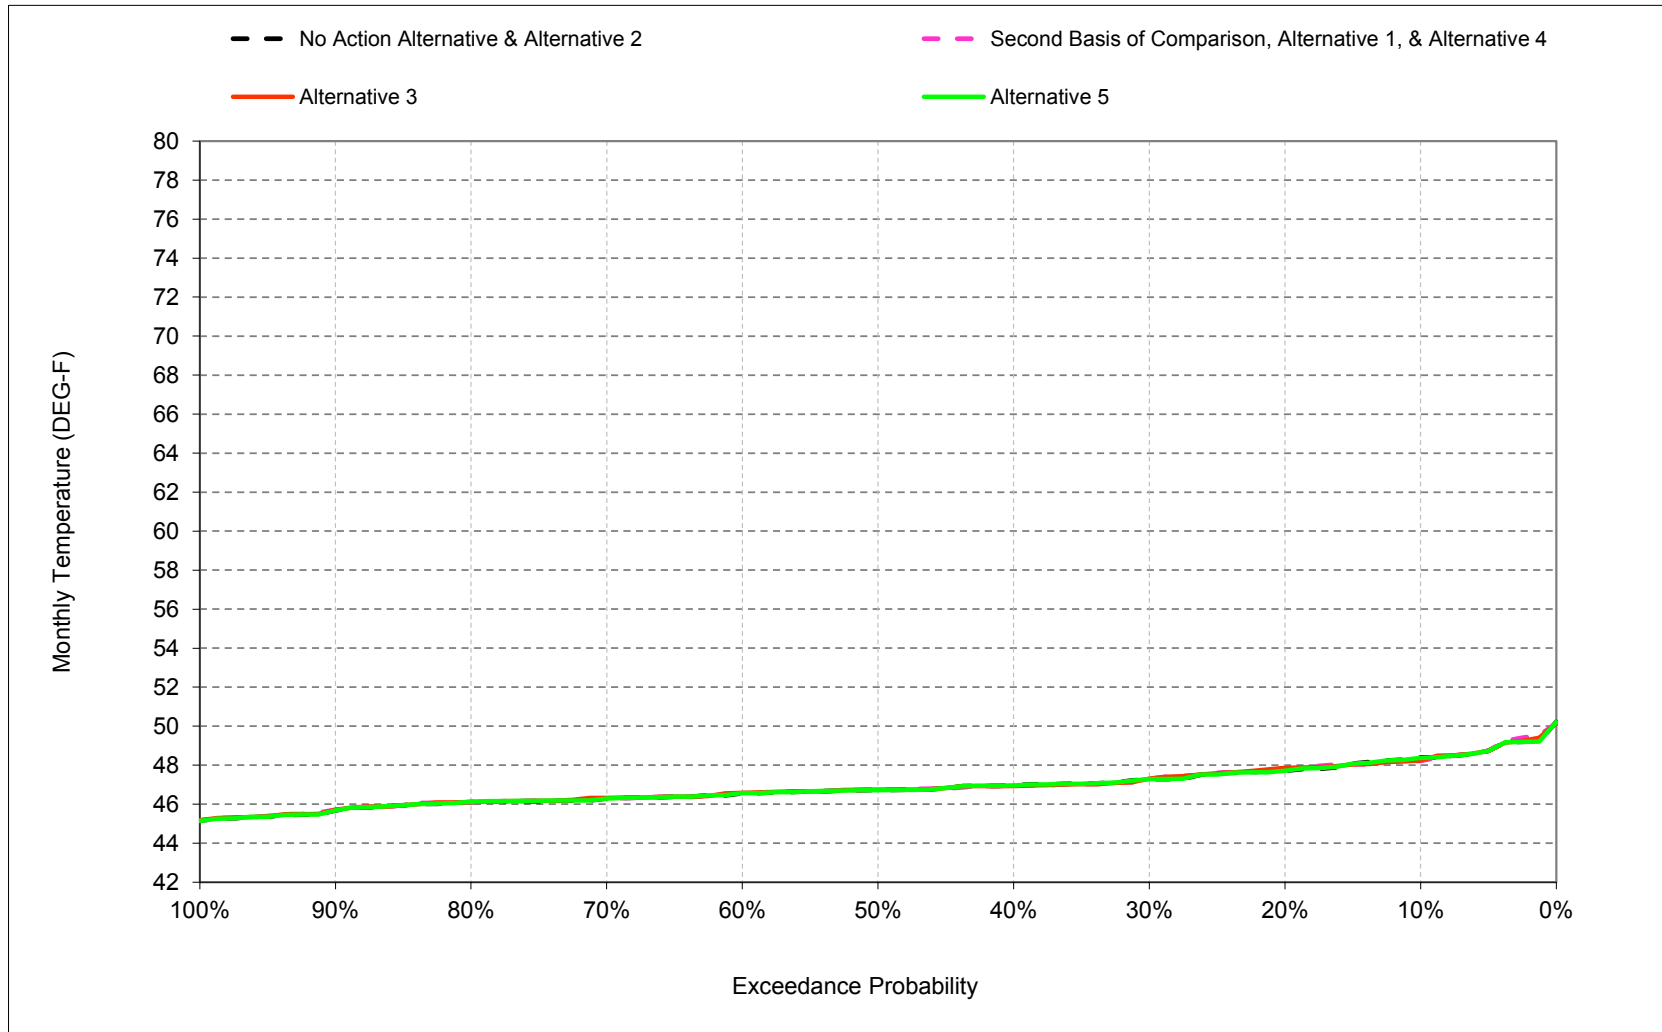


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-11-5. Sacramento River at Knights Landing, February

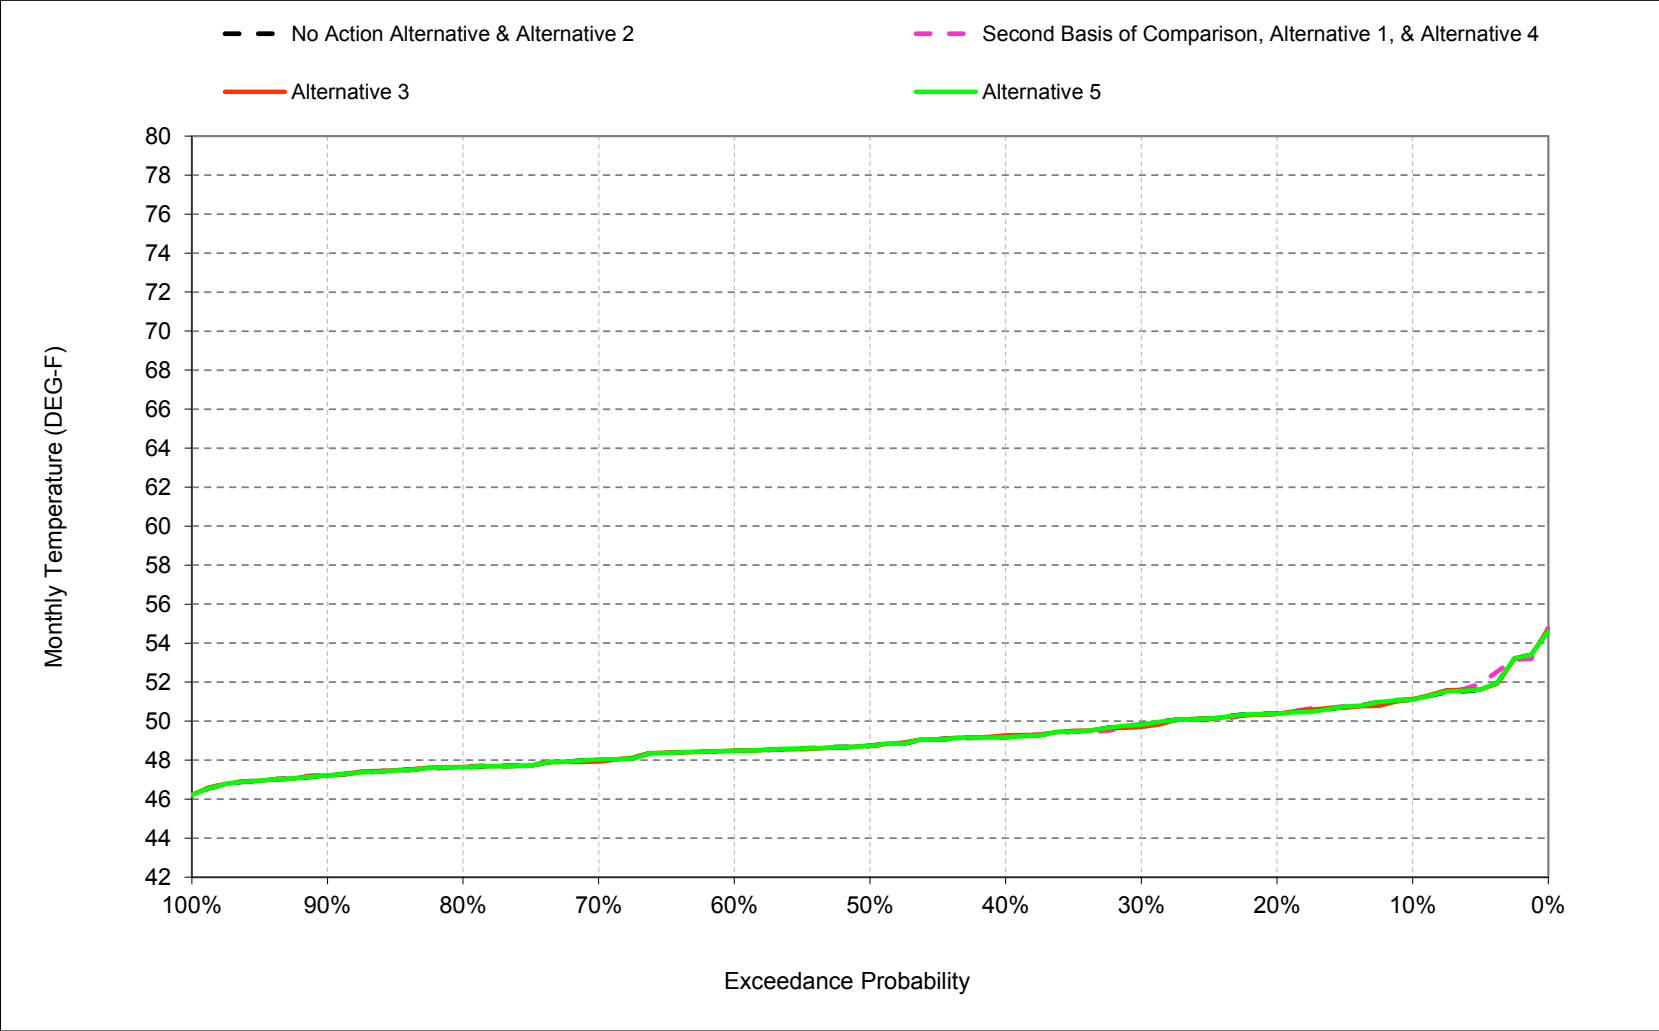


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-11-6. Sacramento River at Knights Landing, March

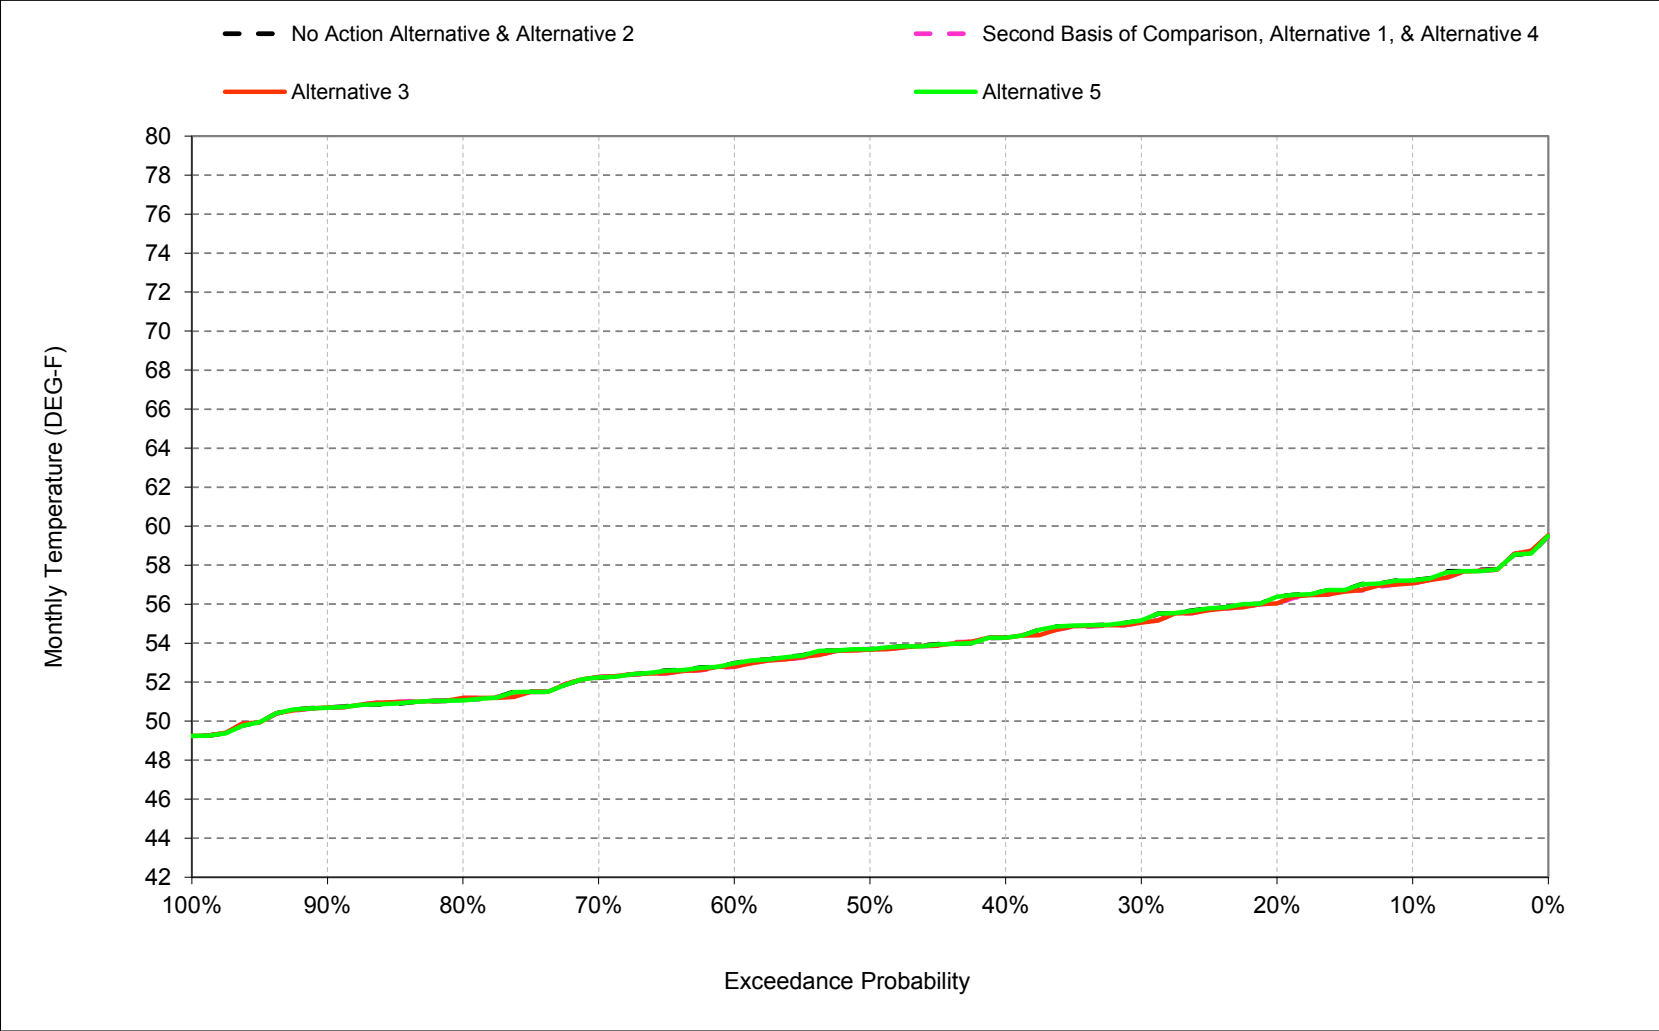


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-11-7. Sacramento River at Knights Landing, April

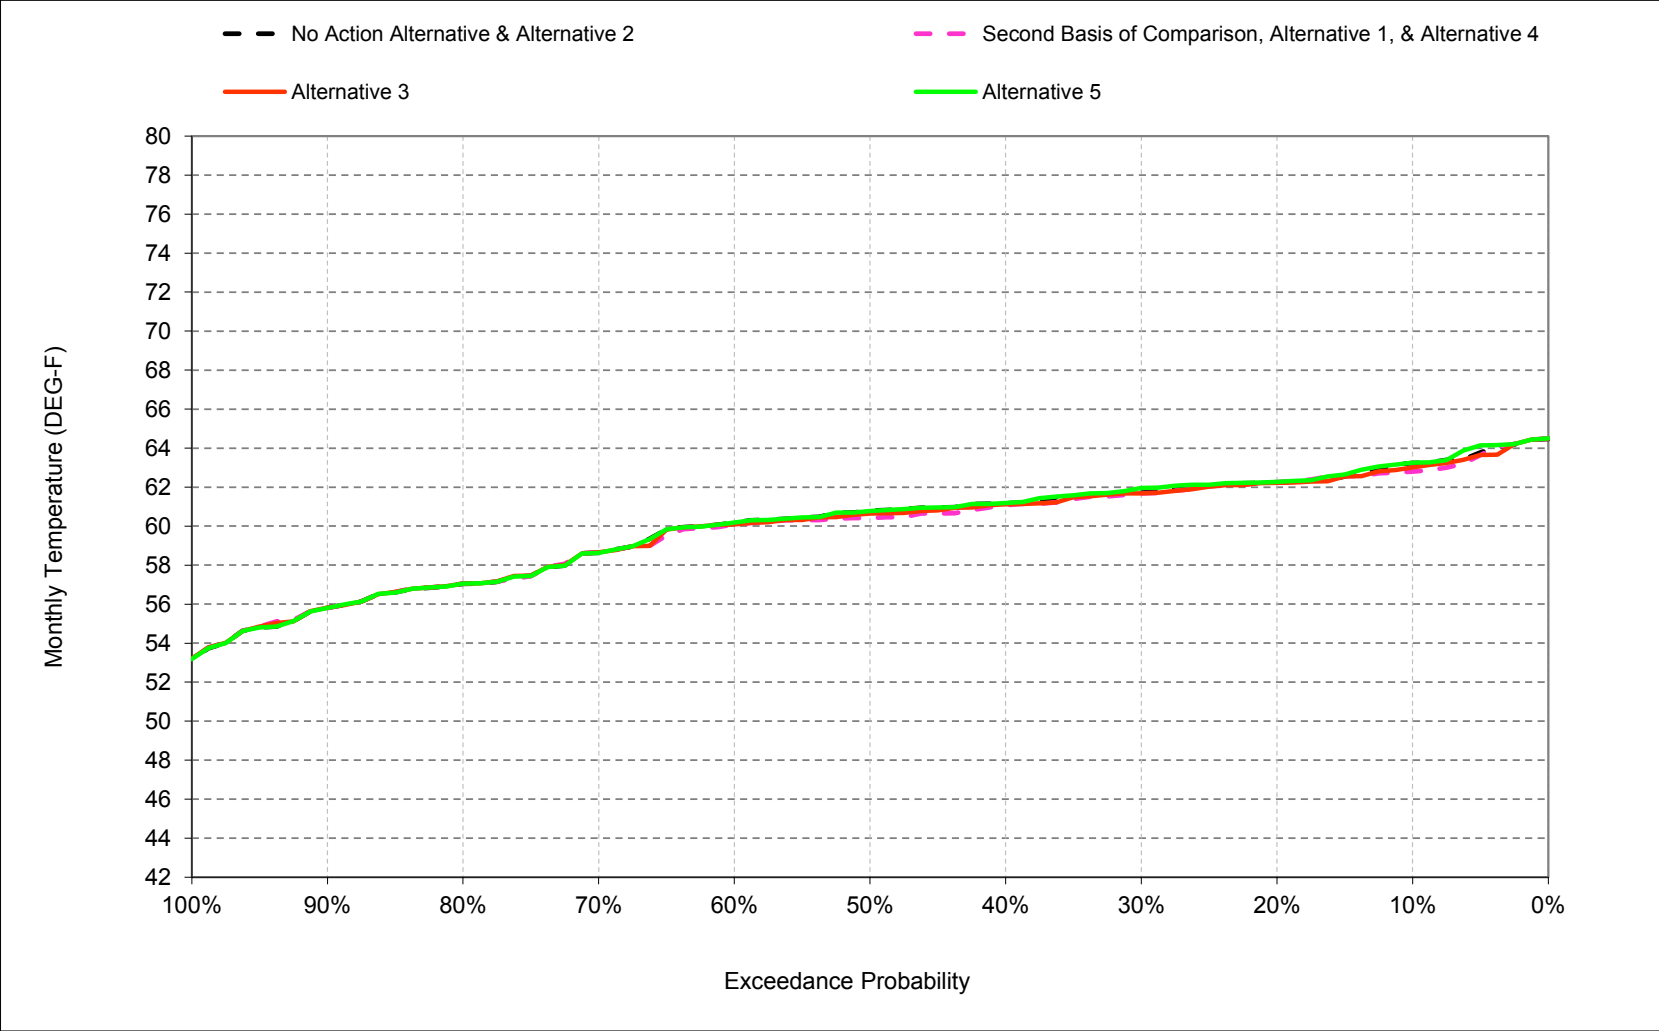


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-11-8. Sacramento River at Knights Landing, May

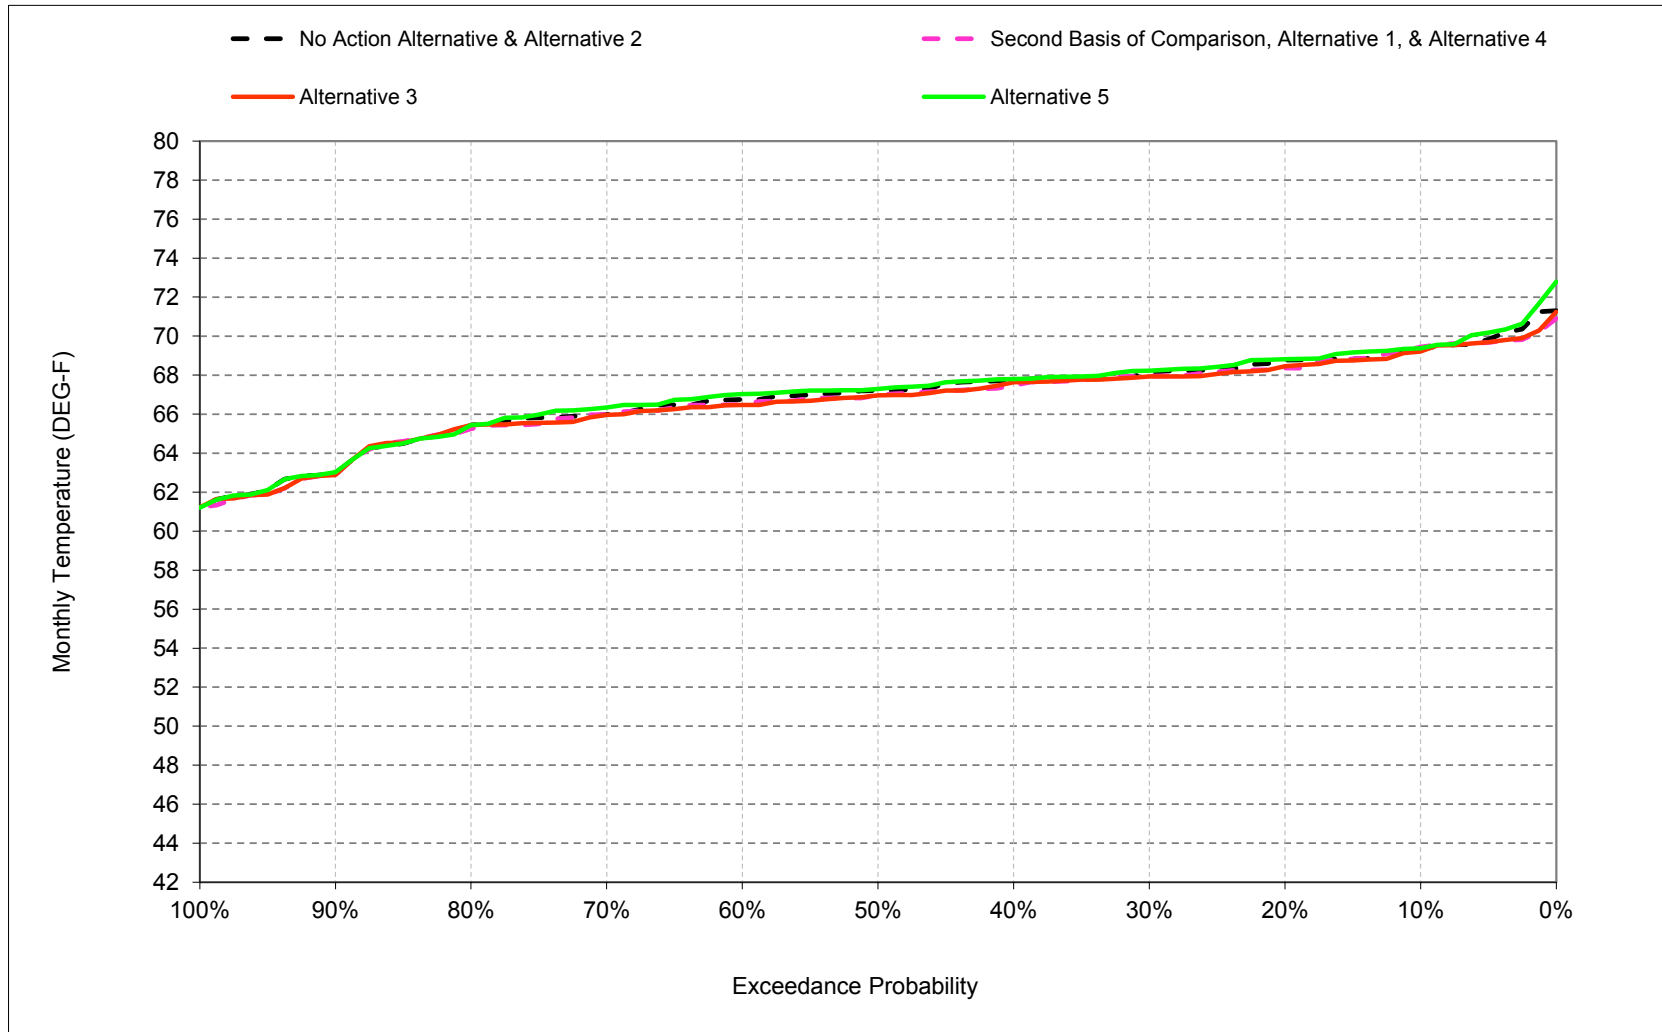


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-11-9. Sacramento River at Knights Landing, June

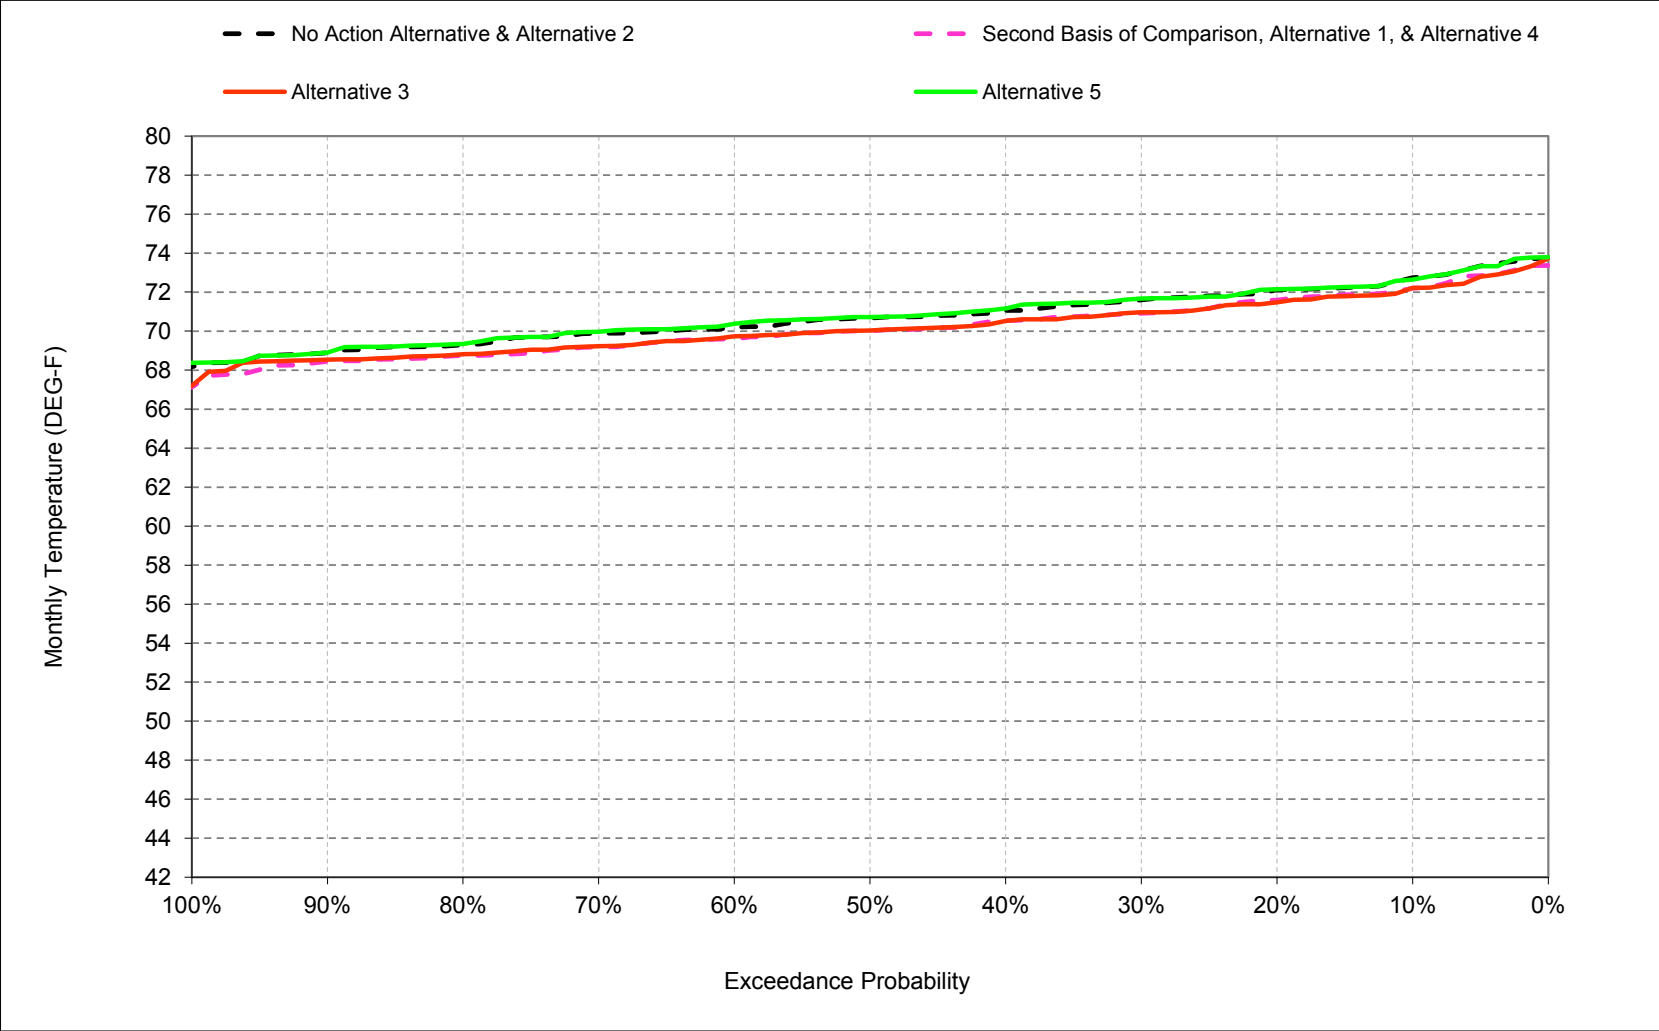


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-11-10. Sacramento River at Knights Landing, July

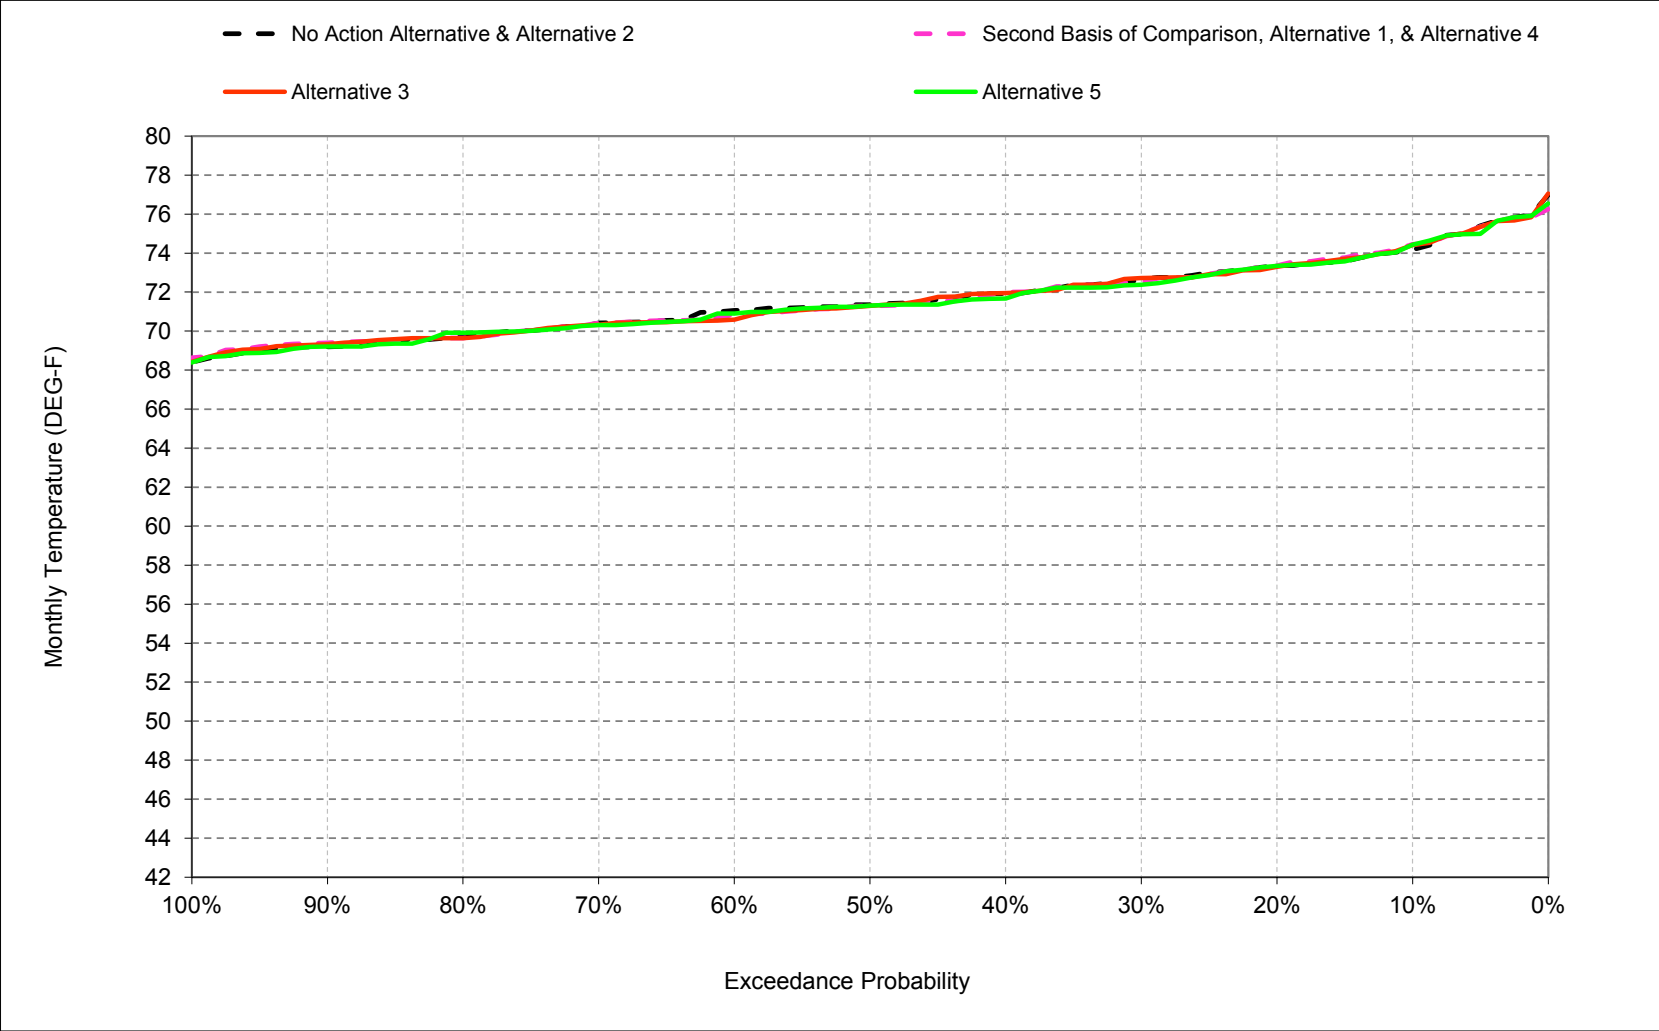


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-11-11. Sacramento River at Knights Landing, August

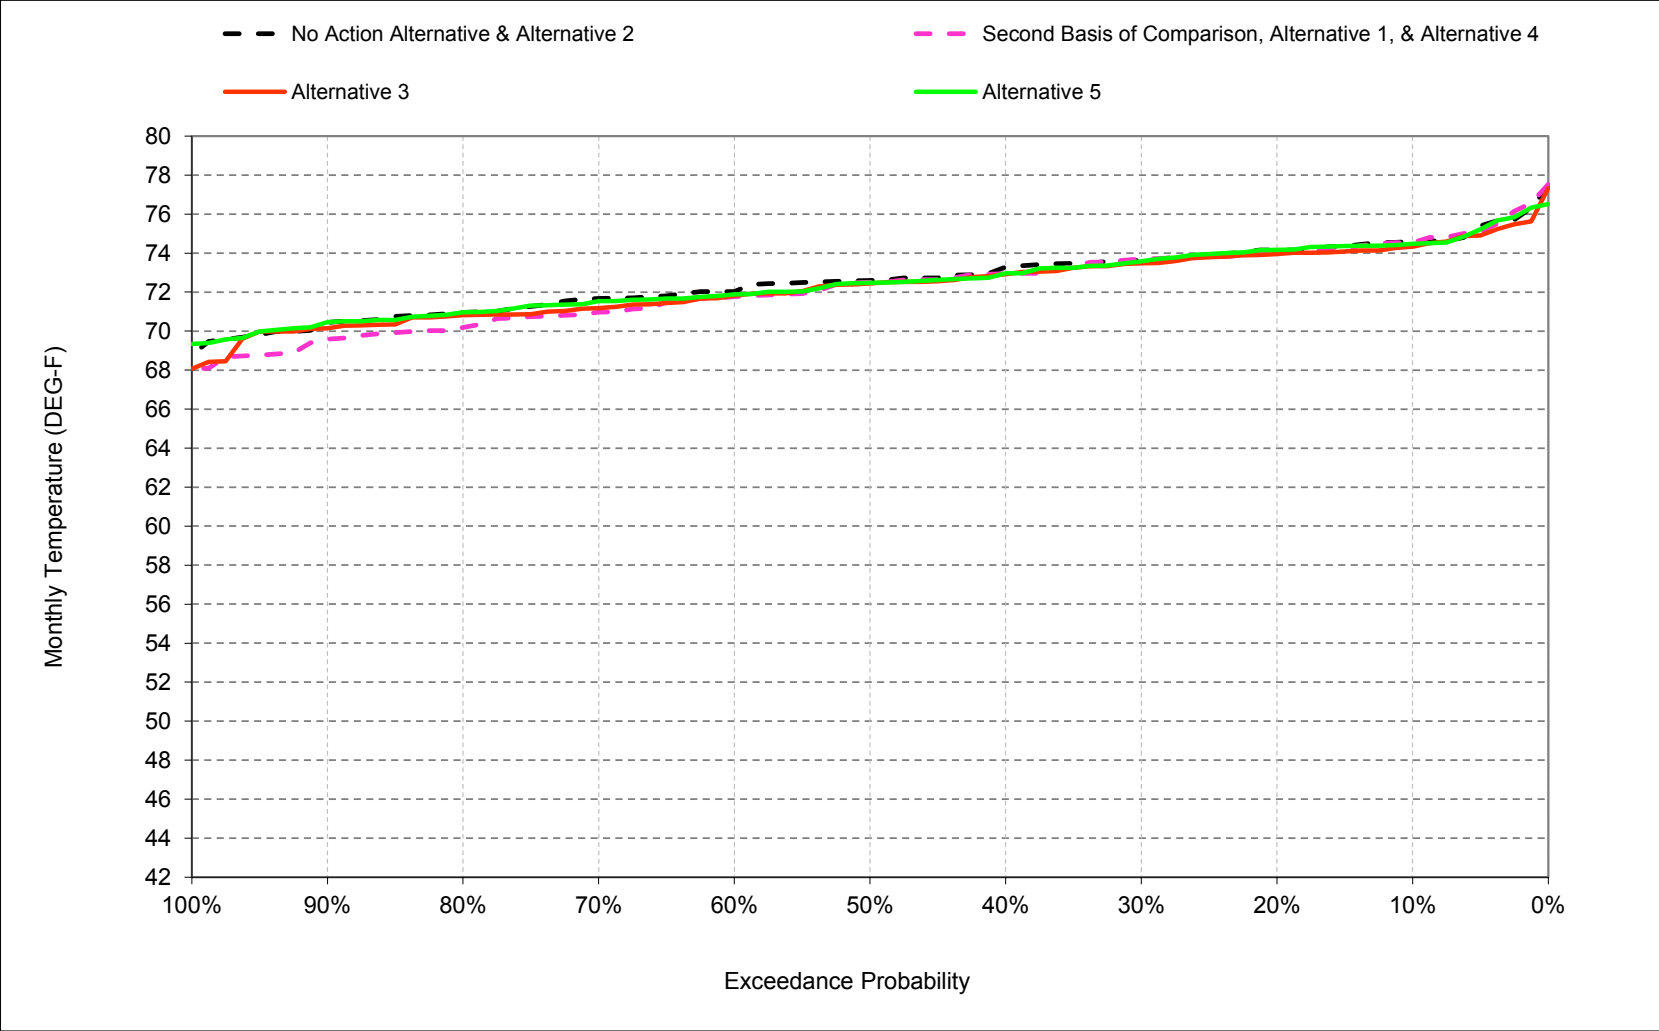

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-11-12. Sacramento River at Knights Landing, September

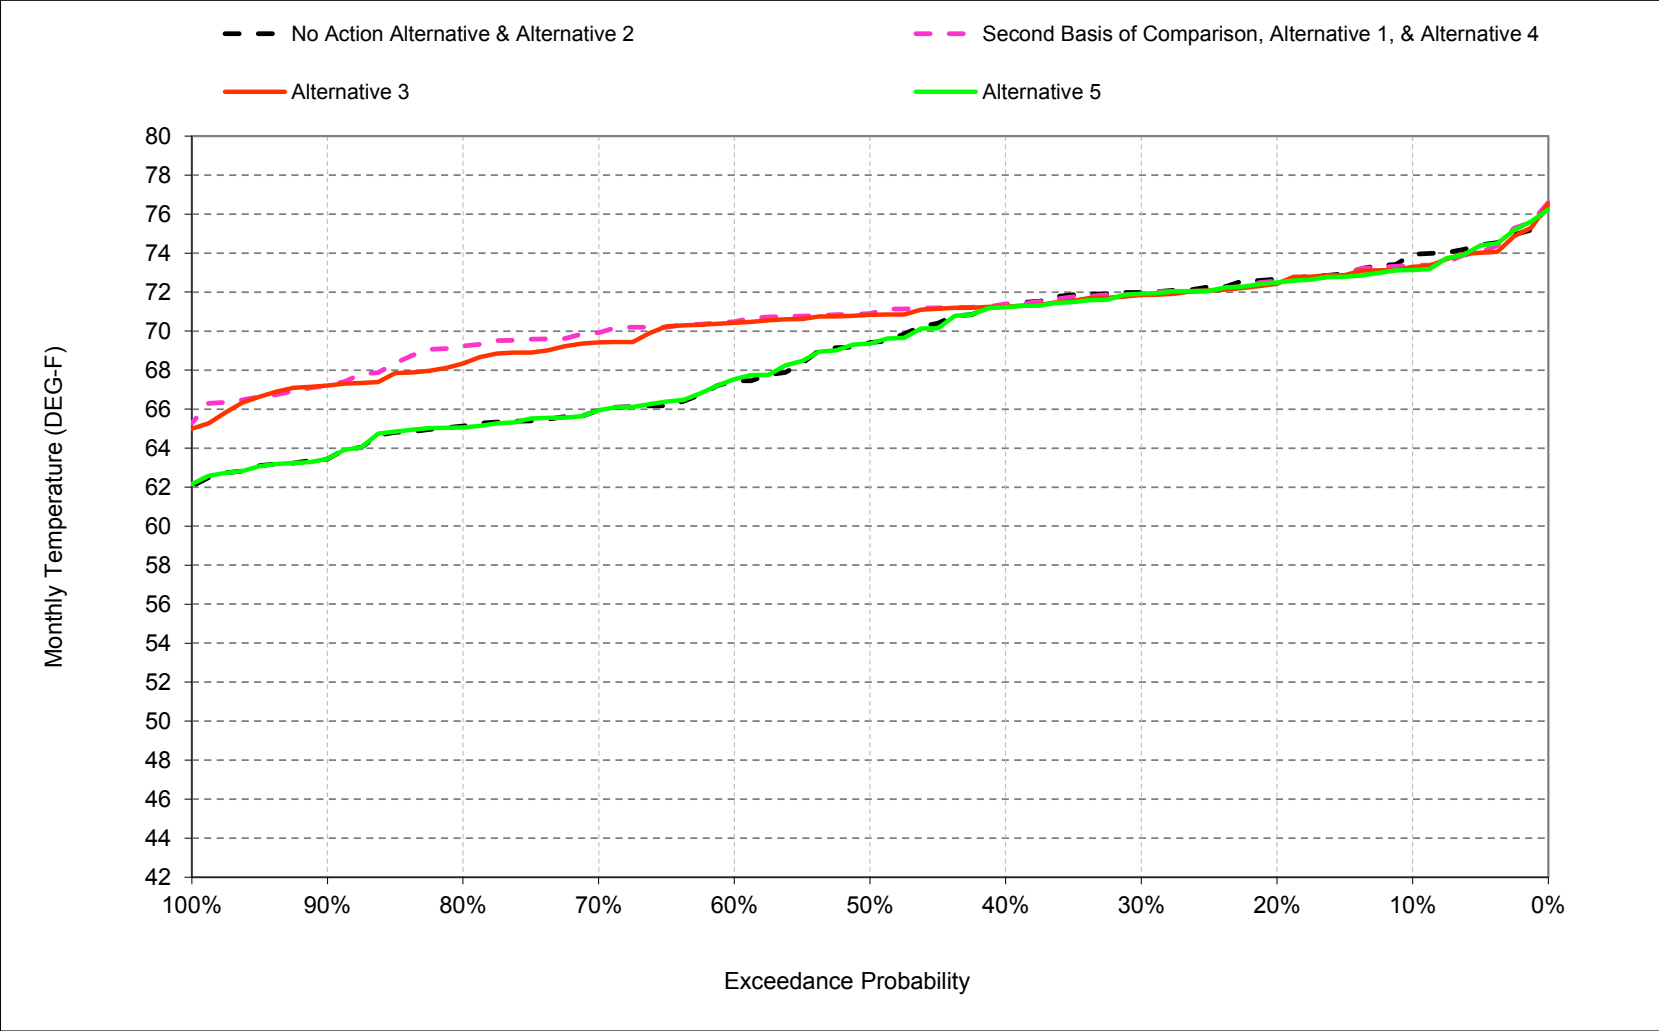

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-11-1. Sacramento River at Knights Landing, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	65	58	50	48	51	57	63	69	73	74	75	74
20%	65	57	50	48	50	56	62	69	72	73	74	73
30%	64	56	49	47	50	55	62	68	72	73	74	72
40%	63	55	49	47	49	54	61	68	71	72	73	71
50%	63	55	48	47	49	54	61	67	71	71	73	69
60%	62	55	48	47	48	53	60	67	70	71	72	67
70%	61	54	48	46	48	52	59	66	70	70	72	66
80%	61	54	48	46	48	51	57	65	69	70	71	65
90%	60	53	47	46	47	51	56	63	69	69	70	63
Long Term												
Full Simulation Period ^b	63	55	49	47	49	54	60	67	71	72	73	69
Water Year Types ^c												
Wet (32%)	60	53	46	46	48	52	57	65	70	72	72	65
Above Normal (16%)	63	55	49	47	48	53	59	67	71	70	72	67
Below Normal (13%)	62	54	48	47	49	55	62	67	70	71	71	71
Dry (24%)	63	55	49	47	50	55	61	68	71	72	73	72
Critical (15%)	65	57	49	47	51	57	63	68	72	74	74	74

Alternative 1												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	66	58	50	48	51	57	63	69	72	74	75	73
20%	64	57	49	48	50	56	62	68	72	73	74	73
30%	64	56	49	47	50	55	62	68	71	73	74	72
40%	64	55	49	47	49	54	61	67	71	72	73	71
50%	63	55	48	47	49	54	60	67	70	71	72	71
60%	63	54	48	47	48	53	60	66	70	71	72	70
70%	62	54	48	46	48	52	59	66	69	70	71	70
80%	62	54	48	46	48	51	57	65	69	70	70	69
90%	61	53	47	46	47	51	56	63	68	69	69	67
Long Term												
Full Simulation Period ^b	63	55	49	47	49	54	60	67	70	72	72	71
Water Year Types ^c												
Wet (32%)	60	53	46	46	48	52	57	65	70	72	72	69
Above Normal (16%)	63	55	49	47	48	52	59	66	70	70	71	70
Below Normal (13%)	62	54	48	47	49	55	61	67	69	70	70	70
Dry (24%)	63	55	49	47	50	55	61	68	70	71	73	72
Critical (15%)	65	57	49	47	51	57	63	68	71	74	74	73

Alternative 1 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.5	0.0	-0.1	-0.2	0.0	-0.2	-0.4	0.1	-0.5	0.3	0.0	-0.5
0.2	-0.1	0.0	-0.3	0.1	0.0	-0.3	0.0	-0.4	-0.5	0.0	-0.1	-0.1
0.3	0.5	0.1	0.0	0.0	-0.1	-0.1	-0.1	-0.1	-0.7	-0.1	0.1	-0.1
0.4	0.4	0.1	-0.2	0.0	0.0	0.0	-0.1	-0.3	-0.5	0.0	-0.2	0.1
0.5	0.3	-0.1	-0.1	0.0	0.0	0.0	-0.3	-0.3	-0.6	-0.1	-0.1	1.6
0.6	0.7	-0.1	-0.1	0.0	0.0	-0.1	-0.1	-0.3	-0.6	-0.3	-0.3	3.2
0.7	0.4	-0.2	0.1	0.0	-0.1	0.0	0.0	0.0	-0.7	0.0	-0.8	4.1
0.8	0.6	-0.3	0.0	0.0	0.0	0.0	0.0	0.0	-0.5	0.0	-0.8	4.1
0.9	0.3	-0.1	-0.1	0.1	0.1	0.0	0.0	-0.1	-0.5	0.2	-0.7	3.7
Long Term												
Full Simulation Period ^b	0.3	0.0	-0.1	0.0	0.0	-0.1	-0.1	-0.2	-0.6	0.0	-0.4	1.8
Water Year Types ^c												
Wet (32%)	0.4	0.0	0.1	0.0	0.0	0.0	0.0	-0.1	-0.1	0.2	-0.7	4.6
Above Normal (16%)	0.3	-0.1	-0.1	0.0	0.0	-0.1	0.0	-0.2	-0.7	0.0	-0.6	2.8
Below Normal (13%)	0.4	-0.1	-0.2	0.0	0.0	-0.3	-0.3	-0.4	-0.9	-0.1	-0.7	-0.2
Dry (24%)	0.2	0.0	-0.1	0.0	0.0	0.0	-0.2	-0.2	-0.7	-0.3	0.3	-0.1
Critical (15%)	0.2	0.0	0.0	0.1	0.1	0.0	0.0	0.0	-0.7	0.1	0.0	-0.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-11-2. Sacramento River at Knights Landing, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	65	58	50	48	51	57	63	69	73	74	75	74
20%	65	57	50	48	50	56	62	69	72	73	74	73
30%	64	56	49	47	50	55	62	68	72	73	74	72
40%	63	55	49	47	49	54	61	68	71	72	73	71
50%	63	55	48	47	49	54	61	67	71	71	73	69
60%	62	55	48	47	48	53	60	67	70	71	72	67
70%	61	54	48	46	48	52	59	66	70	70	72	66
80%	61	54	48	46	48	51	57	65	69	70	71	65
90%	60	53	47	46	47	51	56	63	69	69	70	63
Long Term												
Full Simulation Period ^b	63	55	49	47	49	54	60	67	71	72	73	69
Water Year Types ^c												
Wet (32%)	60	53	46	46	48	52	57	65	70	72	72	65
Above Normal (16%)	63	55	49	47	48	53	59	67	71	70	72	67
Below Normal (13%)	62	54	48	47	49	55	62	67	70	71	71	71
Dry (24%)	63	55	49	47	50	55	61	68	71	72	73	72
Critical (15%)	65	57	49	47	51	57	63	68	72	74	74	74

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	65	57	50	48	51	57	63	69	72	74	74	73
20%	64	57	50	48	50	56	62	68	71	73	74	72
30%	64	56	49	47	50	55	62	68	71	73	73	72
40%	63	55	49	47	49	54	61	68	70	72	73	71
50%	63	55	48	47	49	54	61	67	70	71	72	71
60%	62	55	48	47	48	53	60	66	70	71	72	70
70%	62	54	48	46	48	52	59	66	69	70	71	69
80%	62	54	48	46	48	51	57	65	69	70	71	68
90%	61	53	47	46	47	51	56	63	69	69	70	67
Long Term												
Full Simulation Period ^b	63	55	49	47	49	54	60	67	70	72	72	70
Water Year Types ^c												
Wet (32%)	60	53	46	46	48	52	57	65	70	72	72	69
Above Normal (16%)	63	55	49	47	48	52	59	66	70	70	71	70
Below Normal (13%)	62	54	48	47	49	55	61	67	69	70	71	69
Dry (24%)	63	55	49	47	50	55	61	68	70	71	73	72
Critical (15%)	65	57	49	47	51	57	63	68	71	74	74	73

Alternative 3 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.0	-0.1	-0.1	-0.1	0.0	-0.2	-0.2	-0.2	-0.5	0.2	-0.3	-0.6
0.2	-0.1	0.0	-0.1	0.1	0.0	-0.3	0.0	-0.3	-0.6	-0.1	-0.2	-0.3
0.3	0.1	-0.1	-0.1	0.0	-0.1	-0.1	0.0	-0.1	-0.6	0.1	-0.2	-0.2
0.4	0.1	0.1	-0.1	0.0	0.1	0.0	-0.1	-0.2	-0.6	0.0	-0.3	0.0
0.5	0.1	-0.2	0.0	0.0	0.0	0.0	-0.1	-0.3	-0.6	-0.1	-0.2	1.5
0.6	0.5	-0.1	-0.1	0.1	0.0	-0.1	0.0	-0.3	-0.5	-0.5	-0.3	3.1
0.7	0.6	-0.2	0.1	0.1	-0.1	0.0	0.0	-0.1	-0.7	0.0	-0.5	3.7
0.8	0.6	-0.1	0.0	0.0	0.0	0.0	0.0	0.2	-0.5	0.0	-0.1	3.1
0.9	0.5	-0.1	-0.1	0.0	0.0	0.0	0.0	-0.1	-0.3	0.1	0.0	3.8
Long Term												
Full Simulation Period ^b	0.2	0.0	-0.1	0.0	0.0	-0.1	-0.1	-0.2	-0.5	0.0	-0.3	1.6
Water Year Types ^c												
Wet (32%)	0.4	0.0	0.1	0.0	0.0	0.0	0.0	-0.1	-0.2	0.1	-0.4	4.4
Above Normal (16%)	0.1	-0.1	-0.1	0.0	0.0	-0.1	0.0	-0.3	-0.6	0.0	-0.2	2.9
Below Normal (13%)	0.4	-0.1	-0.2	0.0	0.0	-0.3	-0.2	-0.4	-0.8	-0.1	-0.2	-1.4
Dry (24%)	0.1	0.0	-0.1	0.0	0.0	0.0	-0.1	-0.2	-0.7	-0.3	-0.2	-0.1
Critical (15%)	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.6	0.4	-0.2	-0.4

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-11-3. Sacramento River at Knights Landing, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	65	58	50	48	51	57	63	69	73	74	75	74
20%	65	57	50	48	50	56	62	69	72	73	74	73
30%	64	56	49	47	50	55	62	68	72	73	74	72
40%	63	55	49	47	49	54	61	68	71	72	73	71
50%	63	55	48	47	49	54	61	67	71	71	73	69
60%	62	55	48	47	48	53	60	67	70	71	72	67
70%	61	54	48	46	48	52	59	66	70	70	72	66
80%	61	54	48	46	48	51	57	65	69	70	71	65
90%	60	53	47	46	47	51	56	63	69	69	70	63
Long Term												
Full Simulation Period ^b	63	55	49	47	49	54	60	67	71	72	73	69
Water Year Types ^c												
Wet (32%)	60	53	46	46	48	52	57	65	70	72	72	65
Above Normal (16%)	63	55	49	47	48	53	59	67	71	70	72	67
Below Normal (13%)	62	54	48	47	49	55	62	67	70	71	71	71
Dry (24%)	63	55	49	47	50	55	61	68	71	72	73	72
Critical (15%)	65	57	49	47	51	57	63	68	72	74	74	74

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	65	58	50	48	51	57	63	69	73	74	74	73
20%	64	57	50	48	50	56	62	69	72	73	74	72
30%	64	56	49	47	50	55	62	68	72	72	74	72
40%	63	55	49	47	49	54	61	68	71	72	73	71
50%	63	55	48	47	49	54	61	67	71	71	72	69
60%	62	55	48	47	48	53	60	67	70	71	72	67
70%	61	54	48	46	48	52	59	66	70	70	71	66
80%	61	54	47	46	48	51	57	65	69	70	71	65
90%	60	53	47	45	47	51	56	63	69	69	70	63
Long Term												
Full Simulation Period ^b	63	55	49	47	49	54	60	67	71	72	72	69
Water Year Types ^c												
Wet (32%)	60	53	46	46	48	52	57	65	70	72	72	65
Above Normal (16%)	63	55	49	47	48	53	59	67	71	70	72	67
Below Normal (13%)	62	54	48	47	49	55	62	67	70	71	71	71
Dry (24%)	63	55	49	47	50	55	61	68	71	71	73	72
Critical (15%)	65	57	49	47	51	57	63	69	72	73	74	74

Alternative 5 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.2	-0.1	-0.8
0.2	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	-0.2
0.3	0.0	-0.1	0.0	0.0	0.0	0.0	0.2	0.2	0.1	-0.2	-0.1	-0.1
0.4	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.3	-0.3	-0.1
0.5	-0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	-0.1	-0.1	0.0
0.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3	0.2	-0.1	-0.2	0.0
0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.4	0.1	0.0	-0.2	0.0
0.8	0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.2	0.0	0.0
0.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	-0.1
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	-0.1	-0.1	-0.1
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.1
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.2	-0.1
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.4	0.0	-0.1	-0.3	-0.2
Critical (15%)	-0.1	0.0	0.0	0.0	0.0	0.0	0.2	0.3	0.3	-0.2	-0.3	-0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-11-4. Sacramento River at Knights Landing, Monthly Temperature

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	66	58	50	48	51	57	63	69	72	74	75	73
20%	64	57	49	48	50	56	62	68	72	73	74	73
30%	64	56	49	47	50	55	62	68	71	73	74	72
40%	64	55	49	47	49	54	61	67	71	72	73	71
50%	63	55	48	47	49	54	60	67	70	71	72	71
60%	63	54	48	47	48	53	60	66	70	71	72	70
70%	62	54	48	46	48	52	59	66	69	70	71	70
80%	62	54	48	46	48	51	57	65	69	70	70	69
90%	61	53	47	46	47	51	56	63	68	69	69	67
Long Term												
Full Simulation Period ^b	63	55	49	47	49	54	60	67	70	72	72	71
Water Year Types ^c												
Wet (32%)	60	53	46	46	48	52	57	65	70	72	72	69
Above Normal (16%)	63	55	49	47	48	52	59	66	70	70	71	70
Below Normal (13%)	62	54	48	47	49	55	61	67	69	70	70	70
Dry (24%)	63	55	49	47	50	55	61	68	70	71	73	72
Critical (15%)	65	57	49	47	51	57	63	68	71	74	74	73

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance ^a												
10%	65	58	50	48	51	57	63	69	73	74	75	74
20%	65	57	50	48	50	56	62	69	72	73	74	73
30%	64	56	49	47	50	55	62	68	72	73	74	72
40%	63	55	49	47	49	54	61	68	71	72	73	71
50%	63	55	48	47	49	54	61	67	71	71	73	69
60%	62	55	48	47	48	53	60	67	70	71	72	67
70%	61	54	48	46	48	52	59	66	70	70	72	66
80%	61	54	48	46	48	51	57	65	69	70	71	65
90%	60	53	47	46	47	51	56	63	69	69	70	63
Long Term												
Full Simulation Period ^b	63	55	49	47	49	54	60	67	71	72	73	69
Water Year Types ^c												
Wet (32%)	60	53	46	46	48	52	57	65	70	72	72	65
Above Normal (16%)	63	55	49	47	48	53	59	67	71	70	72	67
Below Normal (13%)	62	54	48	47	49	55	62	67	70	71	71	71
Dry (24%)	63	55	49	47	50	55	61	68	71	72	73	72
Critical (15%)	65	57	49	47	51	57	63	68	72	74	74	74

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative minus Second Basis of Comparison												
Probability of Exceedance ^a												
0.1	-0.5	0.0	0.1	0.2	0.0	0.2	0.4	-0.1	0.5	-0.3	0.0	0.5
0.2	0.1	0.0	0.3	-0.1	0.0	0.3	0.0	0.4	0.5	0.0	0.1	0.1
0.3	-0.5	-0.1	0.0	0.0	0.1	0.1	0.1	0.1	0.7	0.1	-0.1	0.1
0.4	-0.4	-0.1	0.2	0.0	0.0	0.0	0.1	0.3	0.5	0.0	0.2	-0.1
0.5	-0.3	0.1	0.1	0.0	0.0	0.0	0.3	0.3	0.6	0.1	0.1	-1.6
0.6	-0.7	0.1	0.1	0.0	0.0	0.1	0.1	0.3	0.6	0.3	0.3	-3.2
0.7	-0.4	0.2	-0.1	0.0	0.1	0.0	0.0	0.0	0.7	0.0	0.8	-4.1
0.8	-0.6	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.5	0.0	0.8	-4.1
0.9	-0.3	0.1	0.1	-0.1	-0.1	0.0	0.0	0.1	0.5	-0.2	0.7	-3.7
Long Term												
Full Simulation Period ^b	-0.3	0.0	0.1	0.0	0.0	0.1	0.1	0.2	0.6	0.0	0.4	-1.8
Water Year Types ^c												
Wet (32%)	-0.4	0.0	-0.1	0.0	0.0	0.0	0.0	0.1	0.1	-0.2	0.7	-4.6
Above Normal (16%)	-0.3	0.1	0.1	0.0	0.0	0.1	0.0	0.2	0.7	0.0	0.6	-2.8
Below Normal (13%)	-0.4	0.1	0.2	0.0	0.0	0.3	0.3	0.4	0.9	0.1	0.7	0.2
Dry (24%)	-0.2	0.0	0.1	0.0	0.0	0.0	0.2	0.2	0.7	0.3	-0.3	0.1
Critical (15%)	-0.2	0.0	0.0	-0.1	-0.1	0.0	0.0	0.0	0.7	-0.1	0.0	0.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-11-5. Sacramento River at Knights Landing, Monthly Temperature

Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	66	58	50	48	51	57	63	69	72	74	75	73
20%	64	57	49	48	50	56	62	68	72	73	74	73
30%	64	56	49	47	50	55	62	68	71	73	74	72
40%	64	55	49	47	49	54	61	67	71	72	73	71
50%	63	55	48	47	49	54	60	67	70	71	72	71
60%	63	54	48	47	48	53	60	66	70	71	72	70
70%	62	54	48	46	48	52	59	66	69	70	71	70
80%	62	54	48	46	48	51	57	65	69	70	70	69
90%	61	53	47	46	47	51	56	63	68	69	69	67
Long Term												
Full Simulation Period ^b	63	55	49	47	49	54	60	67	70	72	72	71
Water Year Types^c												
Wet (32%)	60	53	46	46	48	52	57	65	70	72	72	69
Above Normal (16%)	63	55	49	47	48	52	59	66	70	70	71	70
Below Normal (13%)	62	54	48	47	49	55	61	67	69	70	70	70
Dry (24%)	63	55	49	47	50	55	61	68	70	71	73	72
Critical (15%)	65	57	49	47	51	57	63	68	71	74	74	73

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	65	57	50	48	51	57	63	69	72	74	74	73
20%	64	57	50	48	50	56	62	68	71	73	74	72
30%	64	56	49	47	50	55	62	68	71	73	73	72
40%	63	55	49	47	49	54	61	68	70	72	73	71
50%	63	55	48	47	49	54	61	67	70	71	72	71
60%	62	55	48	47	48	53	60	66	70	71	72	70
70%	62	54	48	46	48	52	59	66	69	70	71	69
80%	62	54	48	46	48	51	57	65	69	70	71	68
90%	61	53	47	46	47	51	56	63	69	69	70	67
Long Term												
Full Simulation Period ^b	63	55	49	47	49	54	60	67	70	72	72	70
Water Year Types^c												
Wet (32%)	60	53	46	46	48	52	57	65	70	72	72	69
Above Normal (16%)	63	55	49	47	48	52	59	66	70	70	71	70
Below Normal (13%)	62	54	48	47	49	55	61	67	69	70	71	69
Dry (24%)	63	55	49	47	50	55	61	68	70	71	73	72
Critical (15%)	65	57	49	47	51	57	63	68	71	74	74	73

Alternative 3 minus Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
0.1	-0.5	-0.1	0.1	0.0	0.0	0.0	0.2	-0.2	0.0	0.0	-0.2	-0.1
0.2	0.0	0.0	0.2	0.1	0.0	0.0	0.0	0.1	-0.1	-0.1	-0.1	-0.2
0.3	-0.4	-0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	-0.2	-0.1
0.4	-0.3	0.0	0.1	0.0	0.1	0.0	0.1	0.2	-0.1	0.0	-0.1	-0.1
0.5	-0.2	0.0	0.0	0.0	0.0	0.0	0.2	0.0	0.0	0.0	-0.1	-0.1
0.6	-0.2	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.1	-0.2	0.0	-0.1
0.7	0.1	0.0	0.0	0.1	0.0	0.0	0.0	-0.1	0.0	0.0	0.3	-0.5
0.8	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.2	0.0	0.0	0.7	-1.0
0.9	0.2	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.2	-0.1	0.7	0.0
Long Term												
Full Simulation Period ^b	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.2
Water Year Types^c												
Wet (32%)	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.3	-0.2
Above Normal (16%)	-0.2	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.0	0.4	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.0	0.5	-1.2
Dry (24%)	-0.2	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-0.1	-0.5	-0.1
Critical (15%)	-0.2	0.0	0.0	0.0	-0.1	0.0	0.1	0.0	0.1	0.2	-0.2	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-11-6. Sacramento River at Knights Landing, Monthly Temperature

Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	66	58	50	48	51	57	63	69	72	74	75	73
20%	64	57	49	48	50	56	62	68	72	73	74	73
30%	64	56	49	47	50	55	62	68	71	73	74	72
40%	64	55	49	47	49	54	61	67	71	72	73	71
50%	63	55	48	47	49	54	60	67	70	71	72	71
60%	63	54	48	47	48	53	60	66	70	71	72	70
70%	62	54	48	46	48	52	59	66	69	70	71	70
80%	62	54	48	46	48	51	57	65	69	70	70	69
90%	61	53	47	46	47	51	56	63	68	69	69	67
Long Term												
Full Simulation Period ^b	63	55	49	47	49	54	60	67	70	72	72	71
Water Year Types ^c												
Wet (32%)	60	53	46	46	48	52	57	65	70	72	72	69
Above Normal (16%)	63	55	49	47	48	52	59	66	70	70	71	70
Below Normal (13%)	62	54	48	47	49	55	61	67	69	70	70	70
Dry (24%)	63	55	49	47	50	55	61	68	70	71	73	72
Critical (15%)	65	57	49	47	51	57	63	68	71	74	74	73

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	65	58	50	48	51	57	63	69	73	74	74	73
20%	64	57	50	48	50	56	62	69	72	73	74	72
30%	64	56	49	47	50	55	62	68	72	72	74	72
40%	63	55	49	47	49	54	61	68	71	72	73	71
50%	63	55	48	47	49	54	61	67	71	71	72	69
60%	62	55	48	47	48	53	60	67	70	71	72	67
70%	61	54	48	46	48	52	59	66	70	70	71	66
80%	61	54	47	46	48	51	57	65	69	70	71	65
90%	60	53	47	45	47	51	56	63	69	69	70	63
Long Term												
Full Simulation Period ^b	63	55	49	47	49	54	60	67	71	72	72	69
Water Year Types ^c												
Wet (32%)	60	53	46	46	48	52	57	65	70	72	72	65
Above Normal (16%)	63	55	49	47	48	53	59	67	71	70	72	67
Below Normal (13%)	62	54	48	47	49	55	62	67	70	71	71	71
Dry (24%)	63	55	49	47	50	55	61	68	71	71	73	72
Critical (15%)	65	57	49	47	51	57	63	69	72	73	74	74

Alternative 5 minus Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.5	0.0	0.1	0.2	0.0	0.2	0.5	0.0	0.5	0.0	-0.1	-0.2
0.2	0.0	0.0	0.3	-0.1	0.0	0.3	0.0	0.5	0.6	0.0	0.1	-0.1
0.3	-0.4	-0.1	0.0	0.0	0.1	0.1	0.3	0.3	0.8	-0.1	-0.1	0.0
0.4	-0.4	-0.1	0.1	0.0	0.0	0.0	0.1	0.4	0.6	-0.3	-0.1	-0.1
0.5	-0.5	0.1	0.1	0.0	0.0	0.0	0.3	0.4	0.7	0.0	0.0	-1.6
0.6	-0.8	0.1	0.1	0.0	0.0	0.1	0.1	0.5	0.7	0.1	0.1	-3.1
0.7	-0.4	0.2	-0.1	0.0	0.1	0.0	0.0	0.3	0.8	0.0	0.6	-4.1
0.8	-0.5	0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.6	0.3	0.8	-4.1
0.9	-0.3	0.1	0.0	-0.1	-0.1	0.0	0.0	0.1	0.5	-0.2	0.8	-3.8
Long Term												
Full Simulation Period ^b	-0.4	0.0	0.1	0.0	0.0	0.1	0.1	0.3	0.6	-0.1	0.3	-1.9
Water Year Types ^c												
Wet (32%)	-0.4	0.0	-0.1	0.0	0.0	0.0	0.0	0.1	0.1	-0.2	0.7	-4.6
Above Normal (16%)	-0.4	0.1	0.1	0.0	0.0	0.1	0.0	0.3	0.8	0.0	0.6	-2.7
Below Normal (13%)	-0.4	0.1	0.2	0.0	0.0	0.3	0.3	0.4	1.0	0.1	1.0	0.1
Dry (24%)	-0.2	0.0	0.1	0.0	0.0	0.0	0.2	0.6	0.8	0.2	-0.6	-0.1
Critical (15%)	-0.3	0.0	0.0	-0.1	-0.1	0.0	0.2	0.3	1.0	-0.3	-0.3	0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


B.12. American River below Nimbus Temperature

Figure B-12-1. American River below Nimbus Dam, October

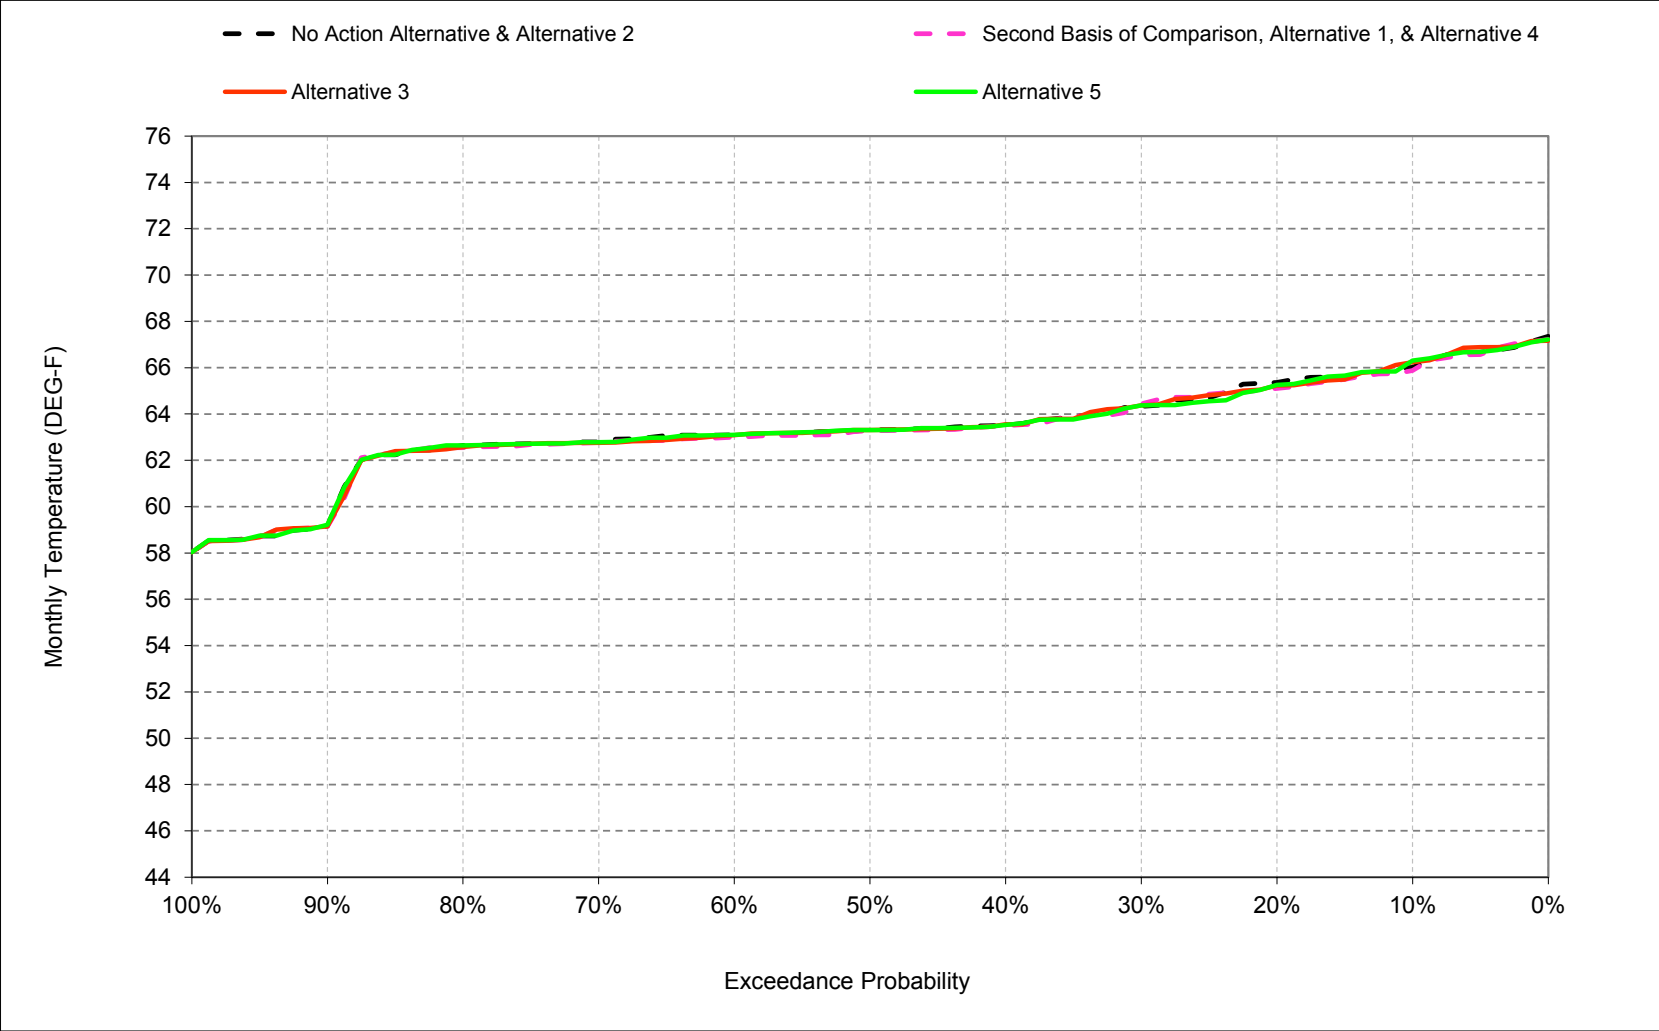


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-12-2. American River below Nimbus Dam, November

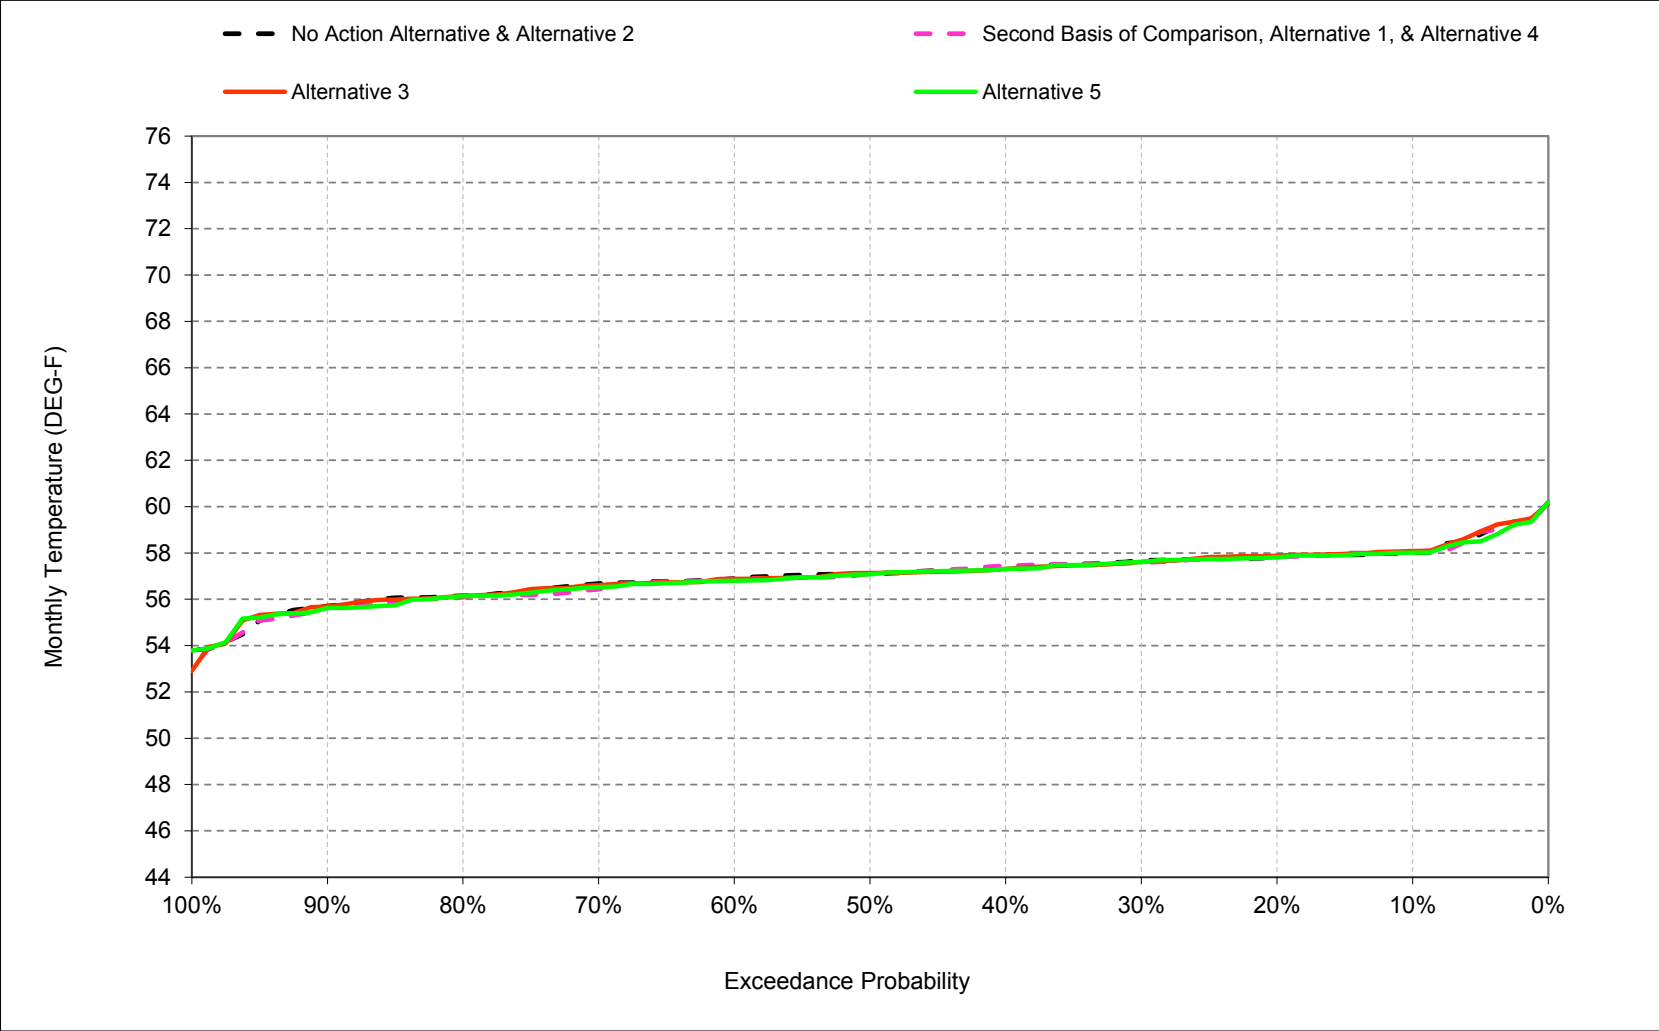


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-12-3. American River below Nimbus Dam, December

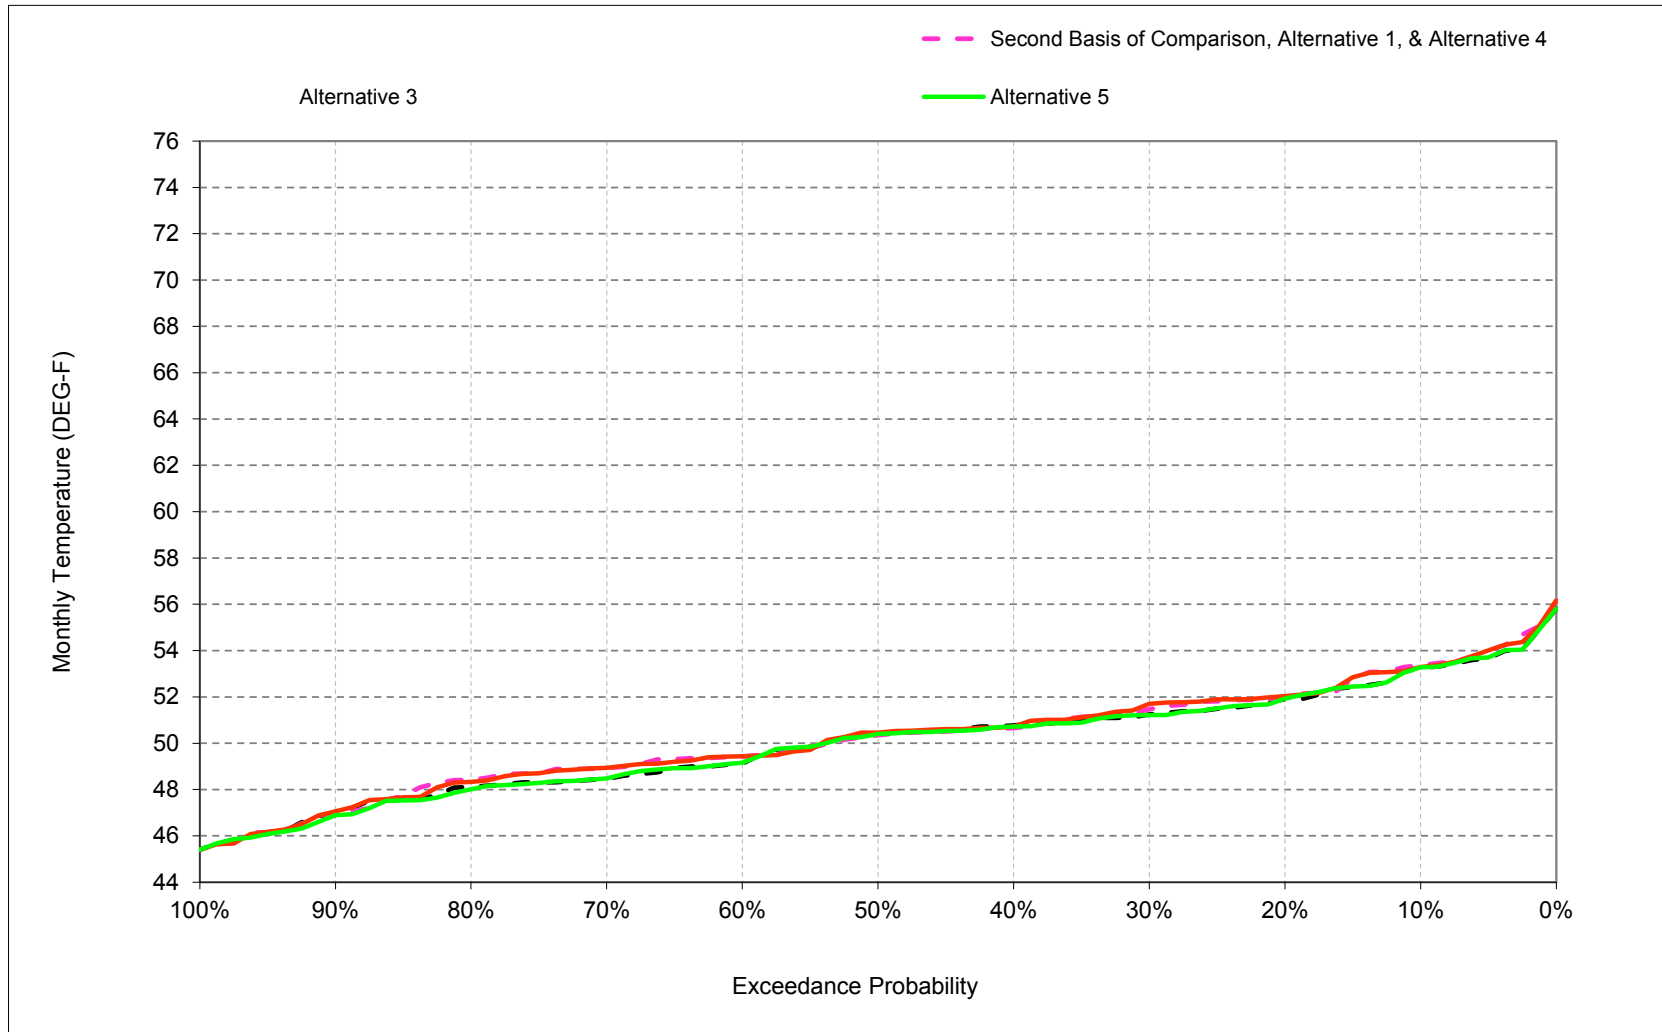


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-12-4. American River below Nimbus Dam, January

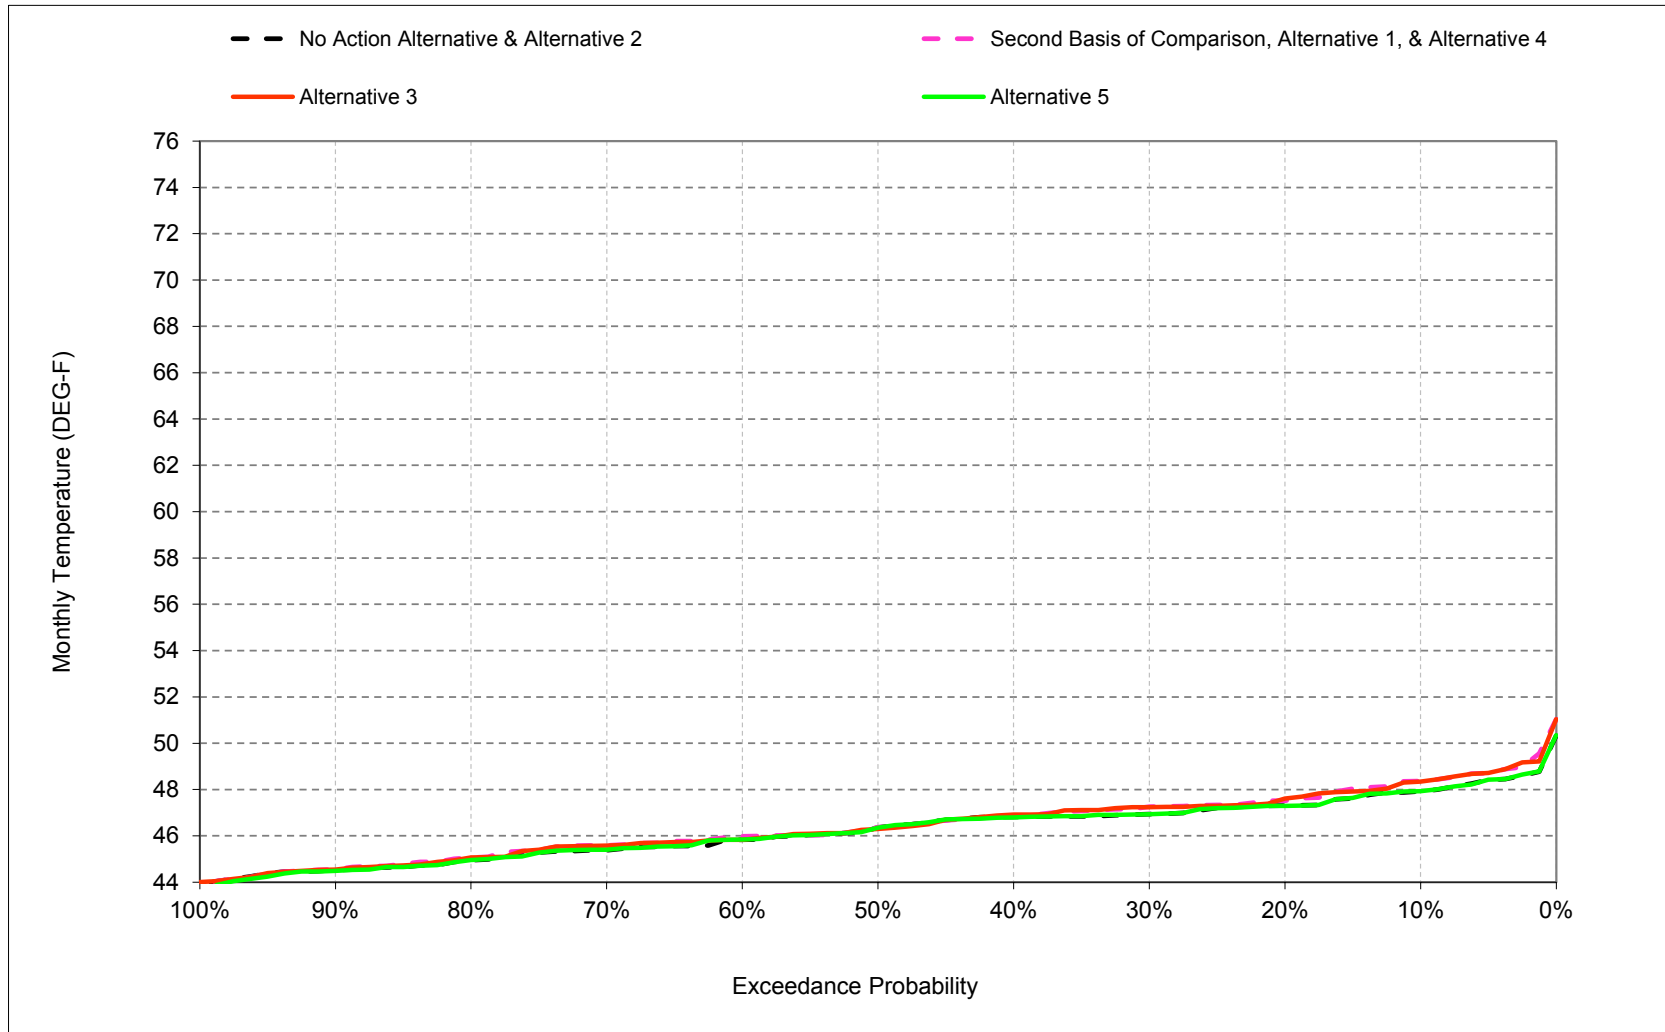


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-12-5. American River below Nimbus Dam, February

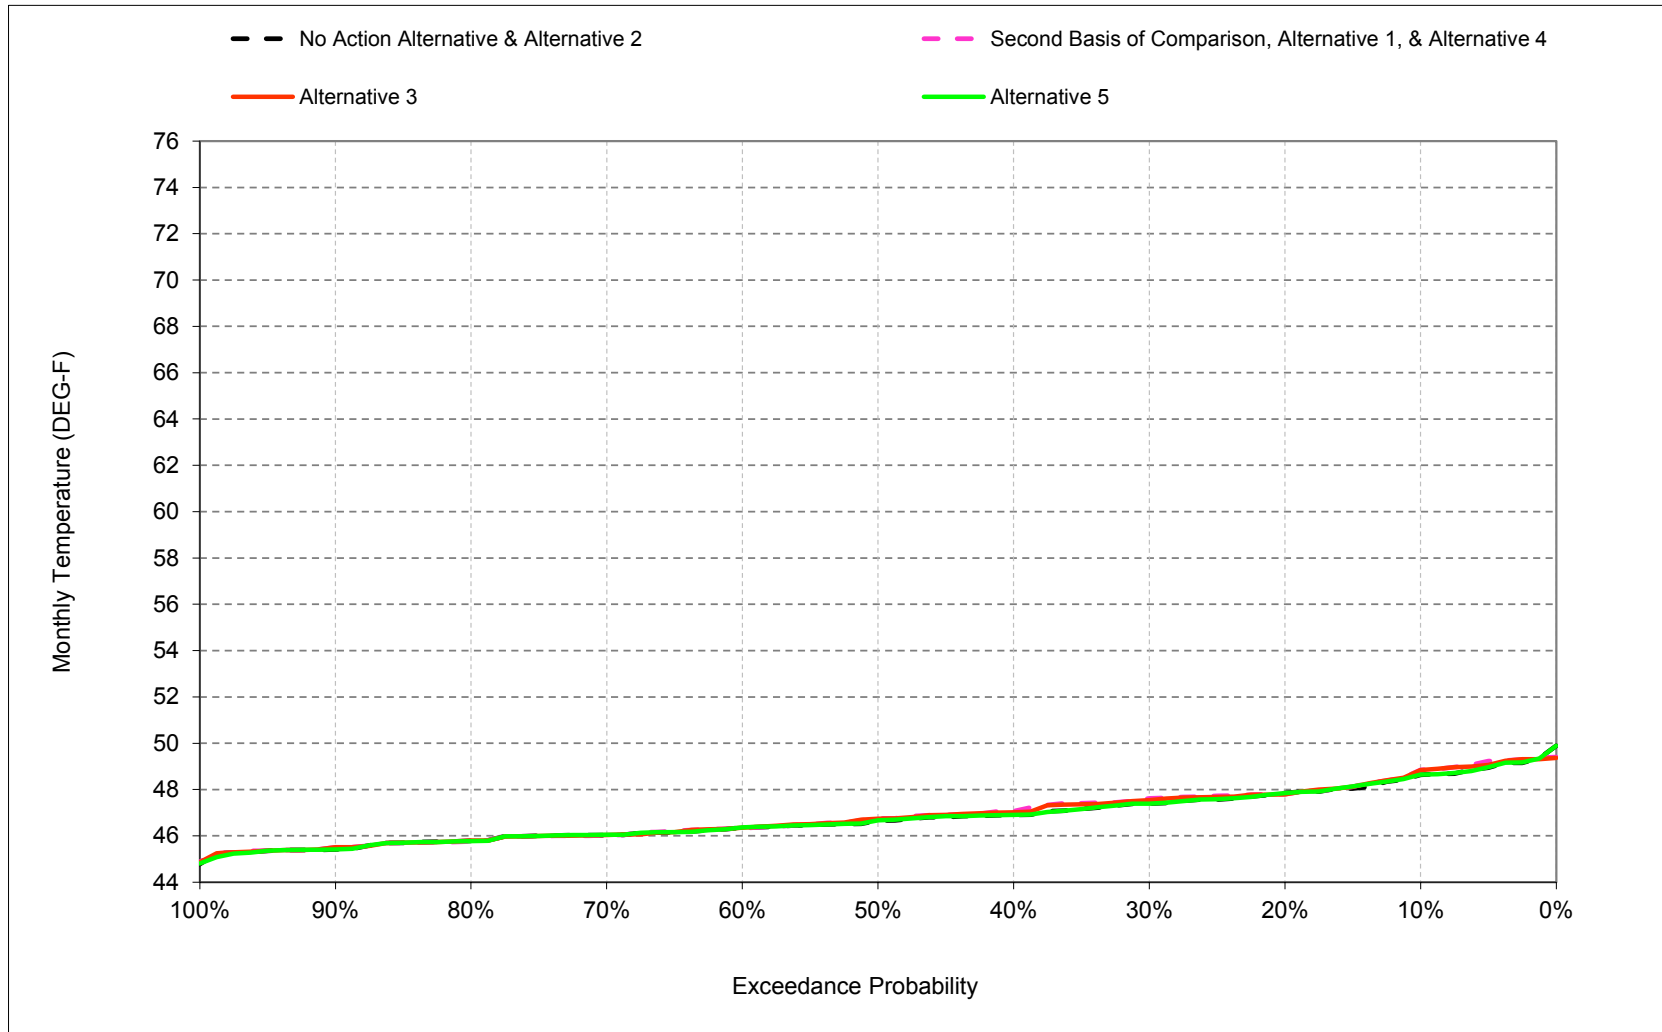


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-12-6. American River below Nimbus Dam, March

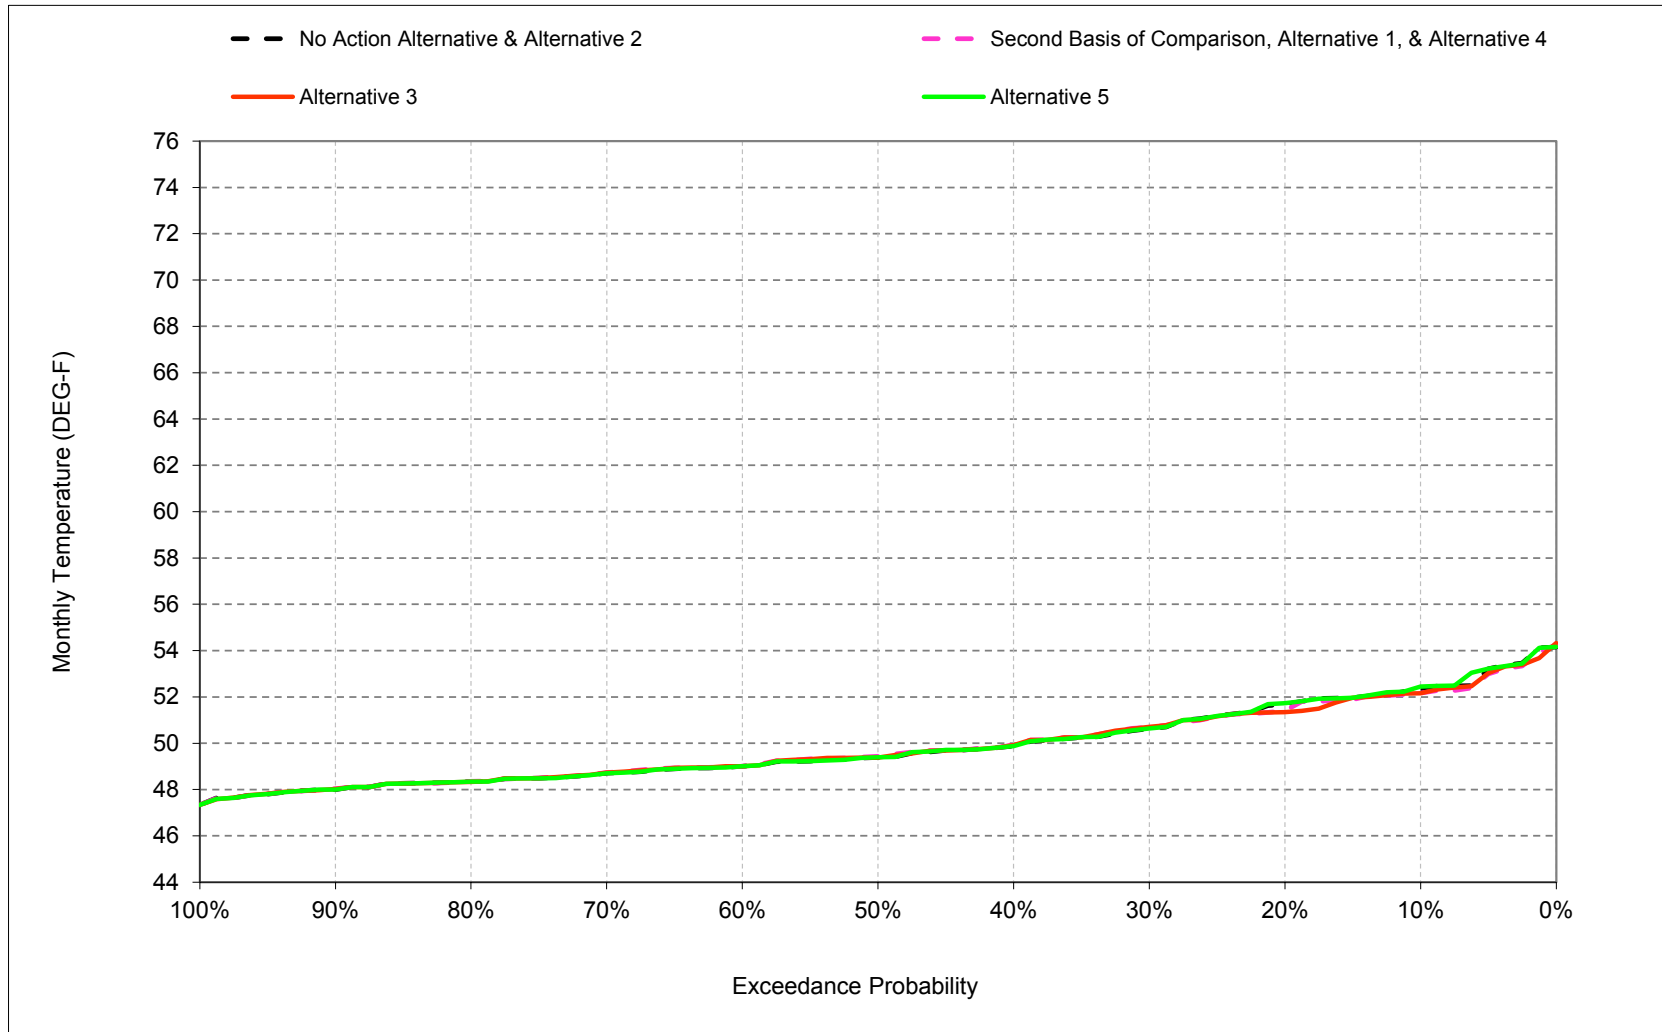


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-12-7. American River below Nimbus Dam, April

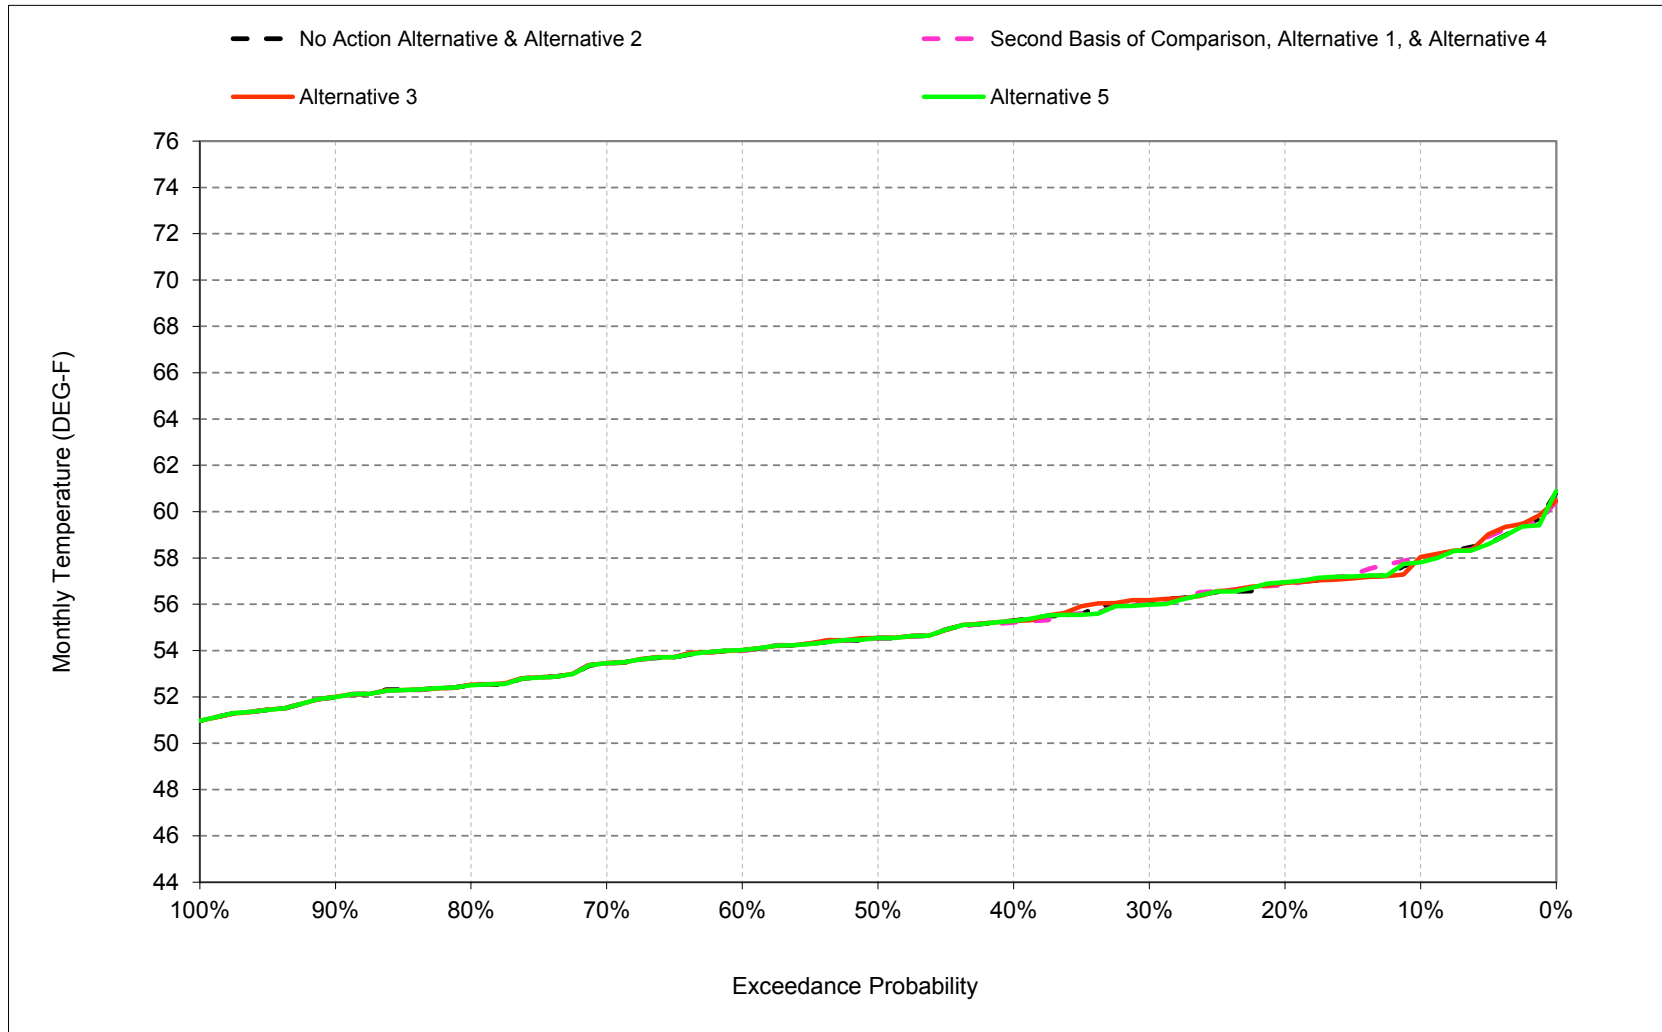


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-12-8. American River below Nimbus Dam, May

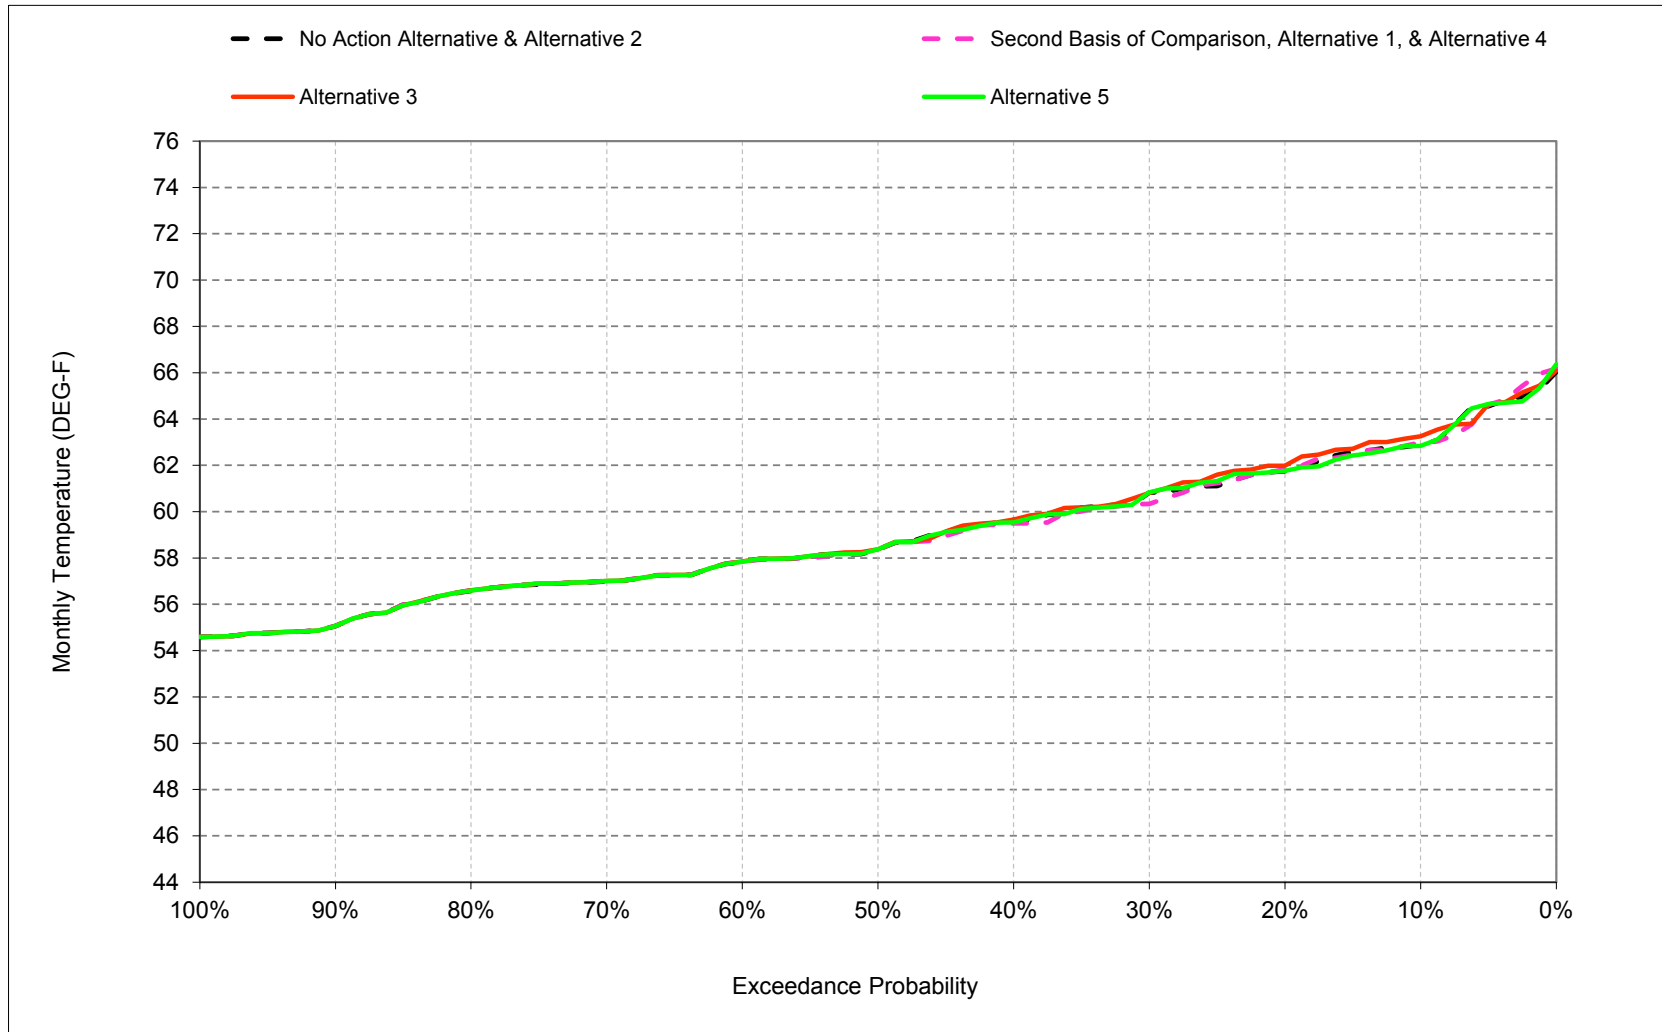


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-12-9. American River below Nimbus Dam, June

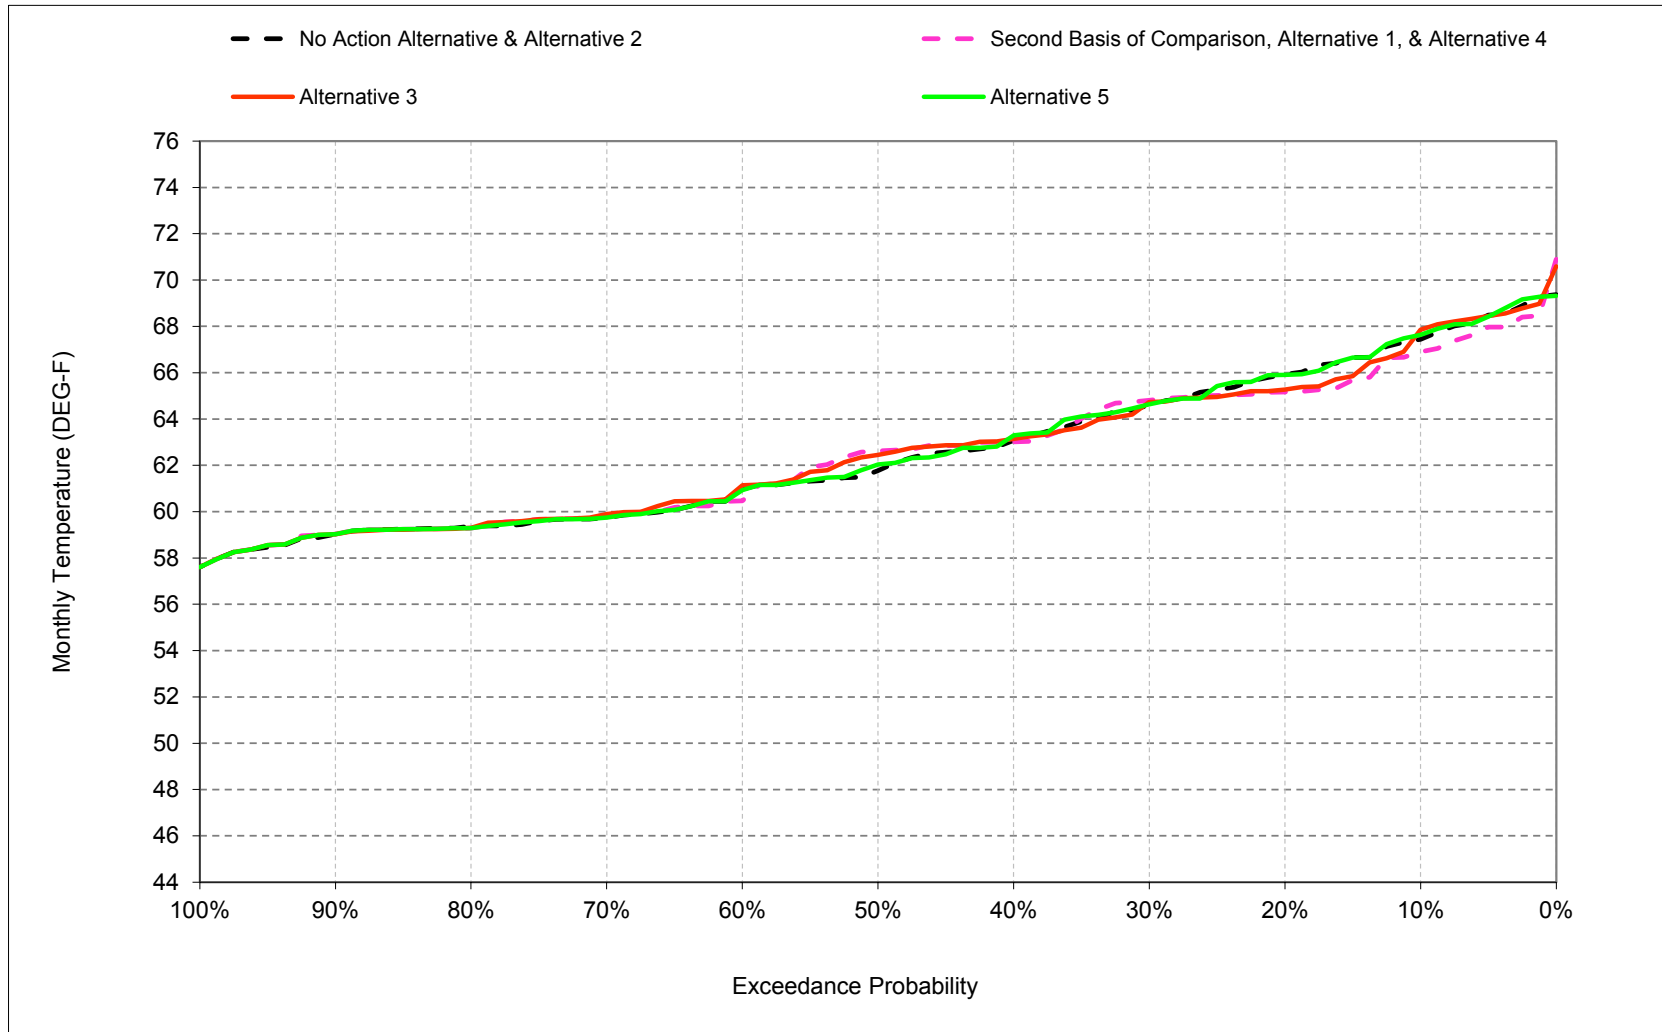


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-12-10. American River below Nimbus Dam, July

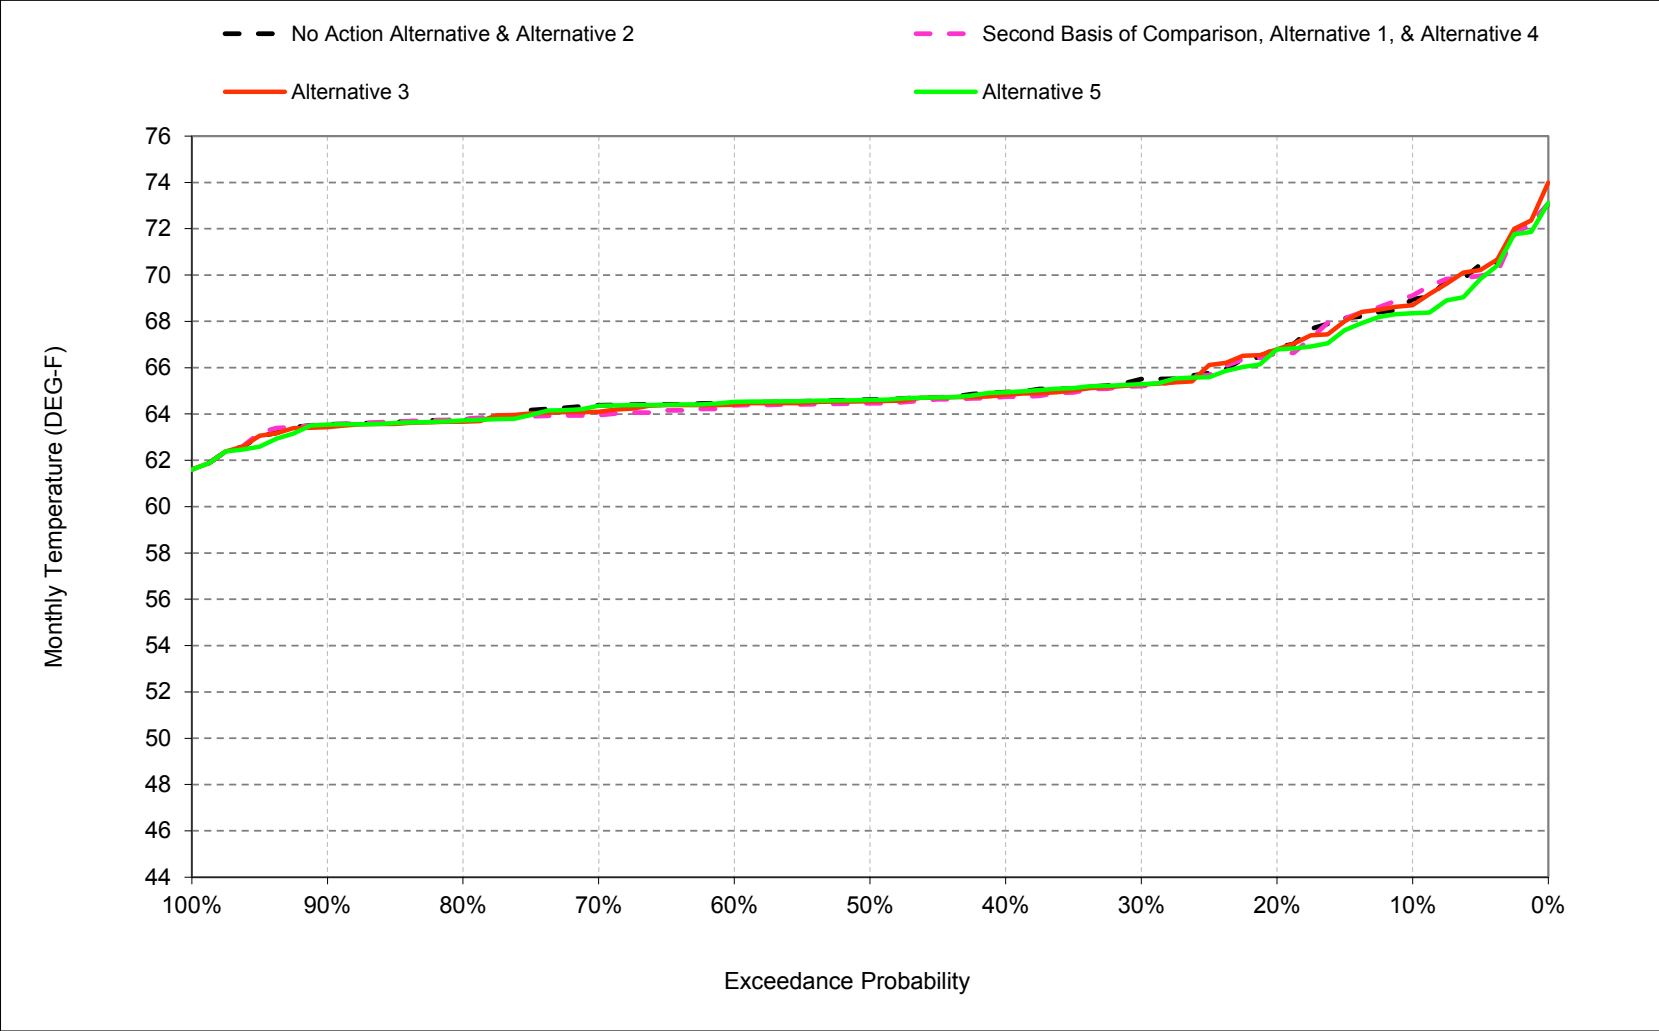


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-12-11. American River below Nimbus Dam, August

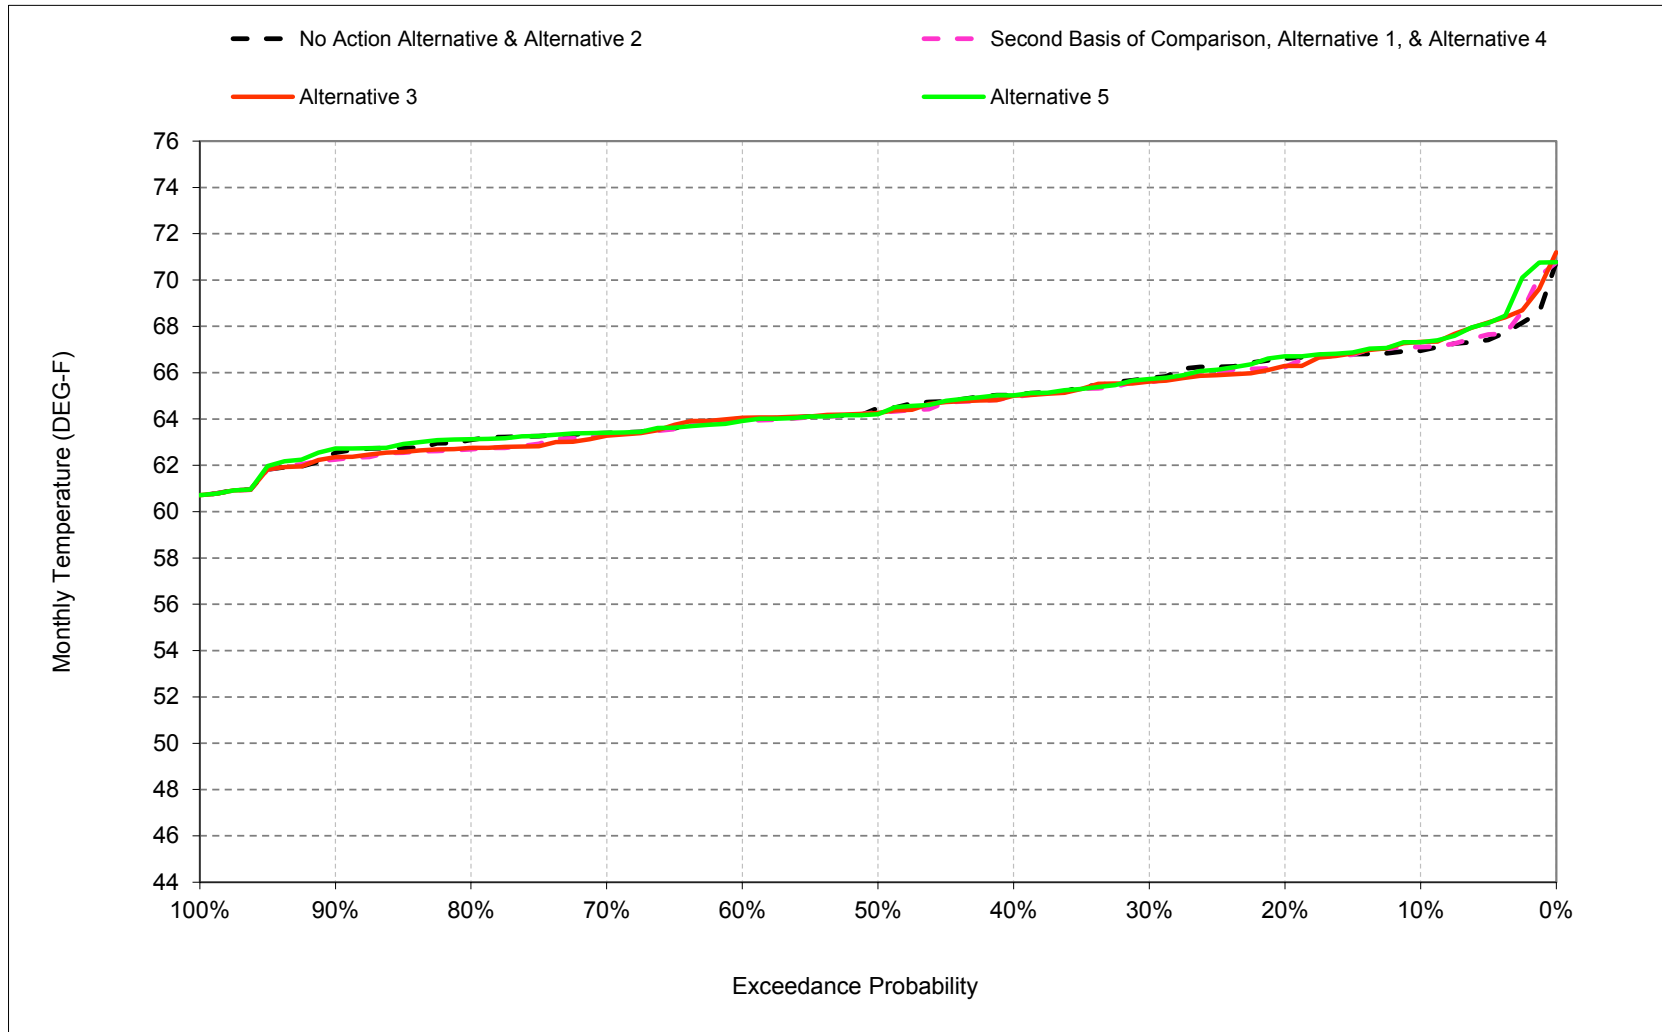

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-12-12. American River below Nimbus Dam, September

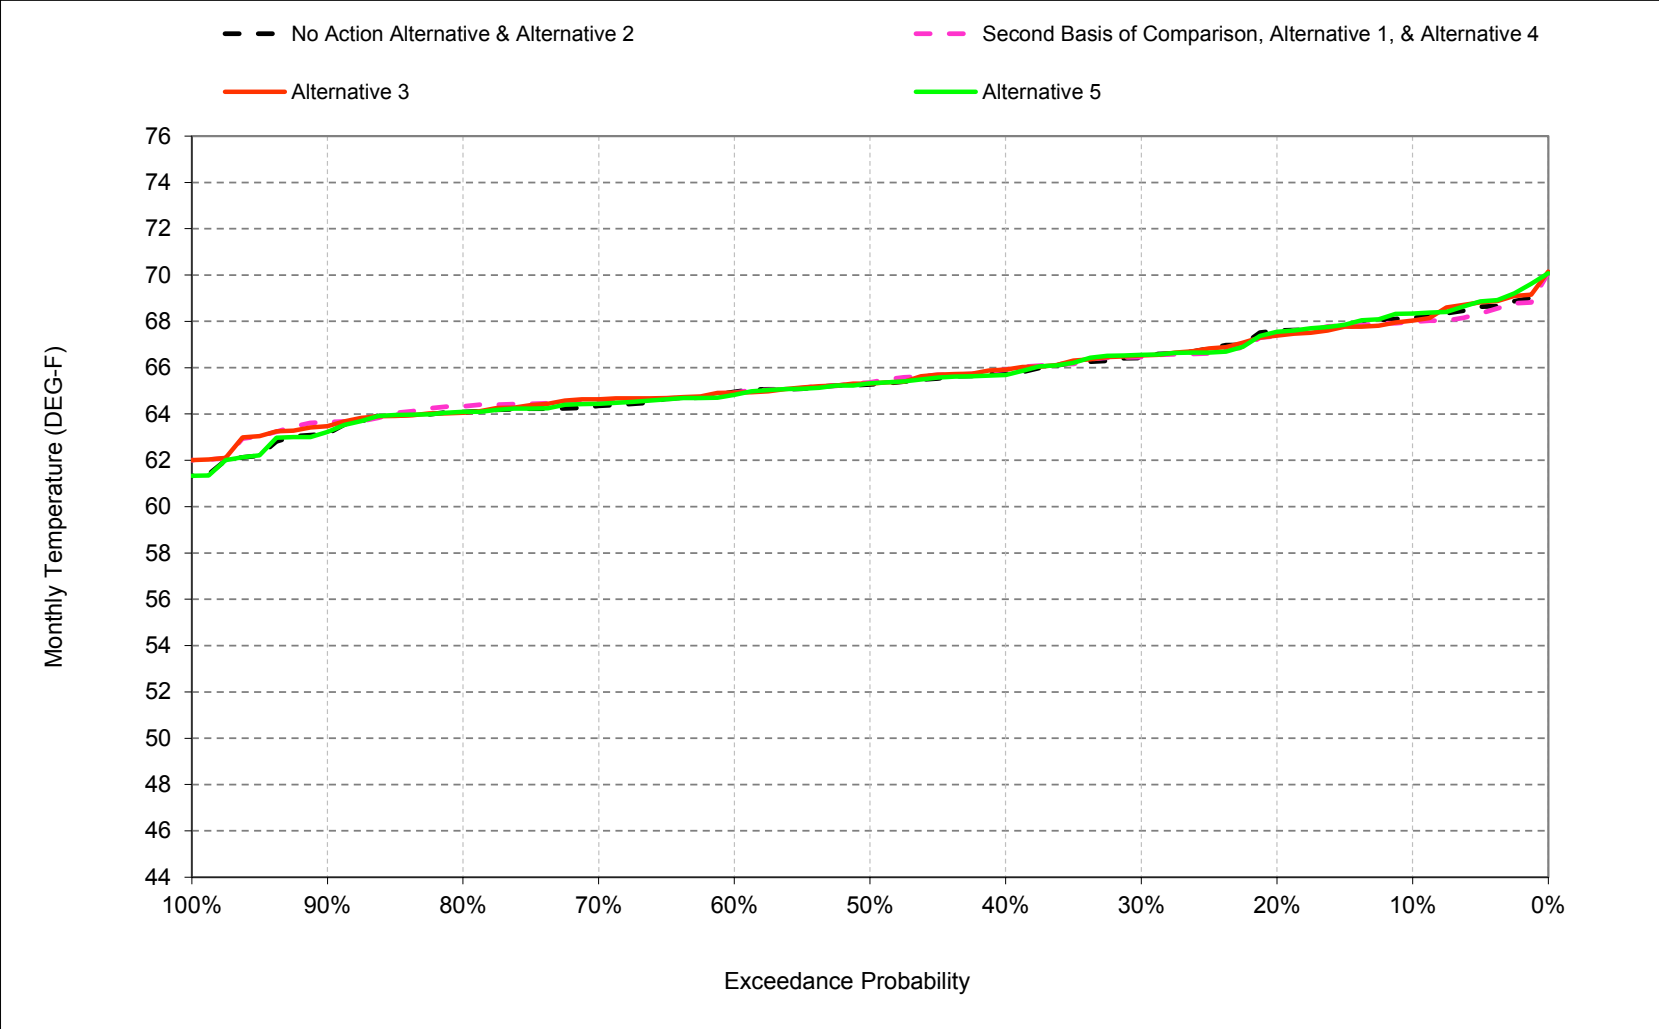

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-12-1. American River below Nimbus Dam, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	66	58	53	48	49	52	58	63	67	69	67	68
20%	65	58	52	47	48	52	57	62	66	67	67	68
30%	64	58	51	47	47	51	56	61	65	65	66	66
40%	64	57	51	47	47	50	55	60	63	65	65	66
50%	63	57	50	46	47	49	54	58	62	65	64	65
60%	63	57	49	46	46	49	54	58	61	64	64	65
70%	63	57	48	45	46	49	53	57	60	64	63	64
80%	63	56	48	45	46	48	52	56	59	64	63	64
90%	59	56	47	44	45	48	52	55	59	64	62	63
Long Term												
Full Simulation Period ^b	63	57	50	46	47	50	55	59	62	65	65	65
Water Year Types ^c												
Wet (32%)	60	55	47	46	46	49	53	57	60	64	63	64
Above Normal (16%)	64	57	50	46	47	49	54	58	62	64	64	65
Below Normal (13%)	62	57	51	47	47	50	56	60	64	65	65	66
Dry (24%)	64	57	51	47	47	51	55	60	64	66	66	66
Critical (15%)	65	58	51	47	48	52	57	62	66	69	67	68

Alternative 1												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	66	58	53	48	49	52	58	63	67	69	67	68
20%	65	58	52	48	48	51	57	62	65	67	66	67
30%	64	58	51	47	48	51	56	60	65	65	66	66
40%	63	57	51	47	47	50	55	59	63	65	65	66
50%	63	57	50	46	47	49	54	58	63	64	64	65
60%	63	57	49	46	46	49	54	58	60	64	64	65
70%	63	56	49	46	46	49	53	57	60	64	63	65
80%	63	56	48	45	46	48	52	57	59	64	63	64
90%	59	56	47	45	45	48	52	55	59	63	62	64
Long Term												
Full Simulation Period ^b	63	57	50	46	47	50	55	59	62	65	65	66
Water Year Types ^c												
Wet (32%)	60	54	48	46	46	49	53	57	60	64	63	64
Above Normal (16%)	63	57	50	47	47	49	54	58	62	64	64	65
Below Normal (13%)	62	57	51	47	47	50	56	60	63	65	65	66
Dry (24%)	64	57	51	47	47	51	56	60	64	66	66	66
Critical (15%)	65	58	51	47	48	52	57	61	66	69	67	68

Alternative 1 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.1	0.0	0.1	0.4	0.2	-0.1	0.2	0.1	-0.6	0.2	0.2	-0.2
0.2	-0.3	0.0	0.0	0.2	0.0	-0.3	-0.1	0.1	-0.7	-0.2	-0.4	-0.2
0.3	0.1	-0.1	0.2	0.3	0.2	0.1	0.0	-0.3	0.2	-0.3	-0.2	0.0
0.4	0.0	0.1	-0.1	0.0	0.2	0.0	-0.1	-0.1	0.0	-0.2	-0.1	0.1
0.5	0.0	0.0	-0.1	0.0	0.1	0.0	0.0	0.0	1.0	-0.1	-0.1	0.1
0.6	-0.1	0.0	0.3	0.1	0.0	0.0	0.0	0.0	-0.2	-0.2	-0.1	-0.1
0.7	0.0	-0.2	0.5	0.2	0.0	0.0	0.0	0.0	0.1	-0.4	-0.1	0.3
0.8	-0.1	-0.1	0.3	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.3	0.2
0.9	0.0	-0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.5
Long Term												
Full Simulation Period ^b	-0.1	-0.1	0.2	0.2	0.1	0.0	0.0	0.0	0.0	-0.1	-0.1	0.1
Water Year Types ^c												
Wet (32%)	-0.1	-0.1	0.2	0.1	0.0	0.0	0.0	0.0	0.1	0.0	-0.3	0.3
Above Normal (16%)	-0.5	-0.4	0.1	0.3	0.1	0.0	0.0	0.0	0.4	-0.2	0.1	0.1
Below Normal (13%)	0.0	0.1	0.3	0.3	0.2	0.0	-0.2	-0.1	-0.9	-0.2	-0.6	0.3
Dry (24%)	0.1	0.0	0.1	0.1	0.0	0.0	0.1	0.2	-0.1	-0.2	0.1	-0.1
Critical (15%)	0.2	0.2	0.1	0.2	0.1	-0.1	0.1	-0.4	0.1	0.2	0.2	-0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Appendix 6B: Surface Water Temperature Modeling

1/0/1900

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	66	58	53	48	49	52	58	63	67	69	67	68
20%	65	58	52	47	48	52	57	62	66	67	67	68
30%	64	58	51	47	47	51	56	61	65	65	66	66
40%	64	57	51	47	47	50	55	60	63	65	65	66
50%	63	57	50	46	47	49	54	58	62	65	64	65
60%	63	57	49	46	46	49	54	58	61	64	64	65
70%	63	57	48	45	46	49	53	57	60	64	63	64
80%	63	56	48	45	46	48	52	56	59	64	63	64
90%	59	56	47	44	45	48	52	55	59	64	62	63
Long Term												
Full Simulation Period ^b	63	57	50	46	47	50	55	59	62	65	65	65
Water Year Types ^c												
Wet (32%)	60	55	47	46	46	49	53	57	60	64	63	64
Above Normal (16%)	64	57	50	46	47	49	54	58	62	64	64	65
Below Normal (13%)	62	57	51	47	47	50	56	60	64	65	65	66
Dry (24%)	64	57	51	47	47	51	55	60	64	66	66	66
Critical (15%)	65	58	51	47	48	52	57	62	66	69	67	68

Alternative 3

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	66	58	53	48	49	52	58	63	68	69	67	68
20%	65	58	52	48	48	51	57	62	65	67	66	67
30%	64	58	52	47	48	51	56	61	65	65	66	67
40%	64	57	51	47	47	50	55	60	63	65	65	66
50%	63	57	50	46	47	49	55	58	62	65	64	65
60%	63	57	49	46	46	49	54	58	61	64	64	65
70%	63	57	49	46	46	49	53	57	60	64	63	65
80%	63	56	48	45	46	48	52	57	59	64	63	64
90%	59	56	47	45	45	48	52	55	59	63	62	63
Long Term												
Full Simulation Period ^b	63	57	50	46	47	50	55	59	63	65	65	66
Water Year Types ^c												
Wet (32%)	60	54	48	46	46	49	53	57	60	64	63	64
Above Normal (16%)	64	57	50	46	47	49	54	58	62	64	64	65
Below Normal (13%)	62	57	51	47	47	50	56	61	63	65	65	66
Dry (24%)	64	57	51	47	47	51	56	60	64	66	66	66
Critical (15%)	65	58	51	47	48	52	57	61	66	69	67	68

Alternative 3 minus No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.2	0.1	0.0	0.4	0.2	-0.1	0.1	0.4	0.3	-0.2	0.4	-0.1
0.2	-0.1	0.1	0.1	0.3	0.0	-0.3	0.0	0.2	-0.6	-0.1	-0.3	-0.2
0.3	0.1	-0.1	0.5	0.3	0.1	0.1	0.1	0.1	0.0	-0.2	-0.1	0.1
0.4	0.0	0.0	-0.1	0.1	0.1	0.0	0.0	0.0	0.1	-0.1	-0.1	0.2
0.5	0.0	0.0	0.0	0.0	0.1	0.0	0.1	0.1	0.8	-0.1	-0.1	0.1
0.6	0.0	0.0	0.3	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.0	0.0
0.7	0.0	-0.1	0.5	0.2	0.0	0.0	0.0	0.0	0.1	-0.3	-0.2	0.3
0.8	-0.1	0.0	0.2	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.3	0.0
0.9	0.0	0.0	0.2	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.0	0.3
Long Term												
Full Simulation Period ^b	0.0	0.0	0.2	0.2	0.1	0.0	0.0	0.1	0.0	0.0	0.0	0.1
Water Year Types ^c												
Wet (32%)	-0.1	-0.1	0.3	0.1	0.0	0.0	0.0	0.0	0.1	0.0	-0.2	0.2
Above Normal (16%)	-0.2	-0.2	0.0	0.2	0.1	0.0	0.0	0.0	0.4	-0.2	0.2	0.1
Below Normal (13%)	0.1	0.4	0.4	0.4	0.2	0.0	-0.1	0.4	-0.3	-0.1	-0.3	0.4
Dry (24%)	0.0	0.0	0.2	0.1	0.0	0.0	0.1	0.3	-0.1	0.0	0.1	-0.2
Critical (15%)	0.1	0.1	0.1	0.1	0.0	-0.2	0.1	-0.4	-0.1	0.1	0.1	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-12-3. American River below Nimbus Dam, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	66	58	53	48	49	52	58	63	67	69	67	68
20%	65	58	52	47	48	52	57	62	66	67	67	68
30%	64	58	51	47	47	51	56	61	65	65	66	66
40%	64	57	51	47	47	50	55	60	63	65	65	66
50%	63	57	50	46	47	49	54	58	62	65	64	65
60%	63	57	49	46	46	49	54	58	61	64	64	65
70%	63	57	48	45	46	49	53	57	60	64	63	64
80%	63	56	48	45	46	48	52	56	59	64	63	64
90%	59	56	47	44	45	48	52	55	59	64	62	63
Long Term												
Full Simulation Period ^b	63	57	50	46	47	50	55	59	62	65	65	65
Water Year Types ^c												
Wet (32%)	60	55	47	46	46	49	53	57	60	64	63	64
Above Normal (16%)	64	57	50	46	47	49	54	58	62	64	64	65
Below Normal (13%)	62	57	51	47	47	50	56	60	64	65	65	66
Dry (24%)	64	57	51	47	47	51	55	60	64	66	66	66
Critical (15%)	65	58	51	47	48	52	57	62	66	69	67	68

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	66	58	53	48	49	52	58	63	68	68	67	68
20%	65	58	52	47	48	52	57	62	66	67	67	68
30%	64	58	51	47	47	51	56	61	65	65	66	67
40%	64	57	51	47	47	50	55	60	63	65	65	66
50%	63	57	50	46	47	49	55	58	62	65	64	65
60%	63	57	49	46	46	49	54	58	61	64	64	65
70%	63	57	48	45	46	49	53	57	60	64	63	64
80%	63	56	48	45	46	48	52	57	59	64	63	64
90%	59	56	47	44	45	48	52	55	59	64	63	63
Long Term												
Full Simulation Period ^b	63	57	50	46	47	50	55	59	63	65	65	66
Water Year Types ^c												
Wet (32%)	60	55	47	46	46	49	53	57	60	64	63	64
Above Normal (16%)	64	57	50	46	47	49	54	58	62	64	64	65
Below Normal (13%)	62	57	51	46	47	50	56	60	64	65	65	66
Dry (24%)	64	57	51	47	47	51	55	60	64	66	66	66
Critical (15%)	65	57	51	47	48	52	57	62	66	68	67	68

Alternative 5 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.3	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.2	-0.6	0.4	0.2
0.2	-0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	-0.1	0.1	-0.1
0.3	0.0	-0.1	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	-0.2	0.0	0.1
0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.0	0.0	-0.1
0.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3	0.0	-0.1	0.0
0.6	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1
0.7	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.1
0.8	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0
0.9	0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.4	-0.1
Long Term												
Full Simulation Period ^b	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.0
Water Year Types ^c												
Wet (32%)	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	0.0	-0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	-0.2	-0.1	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.1
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.1	0.0
Critical (15%)	0.0	-0.1	0.0	0.0	0.0	0.1	-0.1	-0.1	0.1	-0.6	0.2	0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-12-4. American River below Nimbus Dam, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	66	58	53	48	49	52	58	63	67	69	67	68
20%	65	58	52	48	48	51	57	62	65	67	66	67
30%	64	58	51	47	48	51	56	60	65	65	66	66
40%	63	57	51	47	47	50	55	59	63	65	65	66
50%	63	57	50	46	47	49	54	58	63	64	64	65
60%	63	57	49	46	46	49	54	58	60	64	64	65
70%	63	56	49	46	46	49	53	57	60	64	63	65
80%	63	56	48	45	46	48	52	57	59	64	63	64
90%	59	56	47	45	45	48	52	55	59	63	62	64
Long Term												
Full Simulation Period ^b	63	57	50	46	47	50	55	59	62	65	65	66
Water Year Types ^c												
Wet (32%)	60	54	48	46	46	49	53	57	60	64	63	64
Above Normal (16%)	63	57	50	47	47	49	54	58	62	64	64	65
Below Normal (13%)	62	57	51	47	47	50	56	60	63	65	65	66
Dry (24%)	64	57	51	47	47	51	56	60	64	66	66	66
Critical (15%)	65	58	51	47	48	52	57	61	66	69	67	68

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	66	58	53	48	49	52	58	63	67	69	67	68
20%	65	58	52	47	48	52	57	62	66	67	67	68
30%	64	58	51	47	47	51	56	61	65	65	66	66
40%	64	57	51	47	47	50	55	60	63	65	65	66
50%	63	57	50	46	47	49	54	58	62	65	64	65
60%	63	57	49	46	46	49	54	58	61	64	64	65
70%	63	57	48	45	46	49	53	57	60	64	63	64
80%	63	56	48	45	46	48	52	56	59	64	63	64
90%	59	56	47	44	45	48	52	55	59	64	62	63
Long Term												
Full Simulation Period ^b	63	57	50	46	47	50	55	59	62	65	65	65
Water Year Types ^c												
Wet (32%)	60	55	47	46	46	49	53	57	60	64	63	64
Above Normal (16%)	64	57	50	46	47	49	54	58	62	64	64	65
Below Normal (13%)	62	57	51	47	47	50	56	60	64	65	65	66
Dry (24%)	64	57	51	47	47	51	55	60	64	66	66	66
Critical (15%)	65	58	51	47	48	52	57	62	66	69	67	68

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.1	0.0	-0.1	-0.4	-0.2	0.1	-0.2	-0.1	0.6	-0.2	-0.2	0.2
0.2	0.3	0.0	0.0	-0.2	0.0	0.3	0.1	-0.1	0.7	0.2	0.4	0.2
0.3	-0.1	0.1	-0.2	-0.3	-0.2	-0.1	0.0	0.3	-0.2	0.3	0.2	0.0
0.4	0.0	-0.1	0.1	0.0	-0.2	0.0	0.1	0.1	0.0	0.2	0.1	-0.1
0.5	0.0	0.0	0.1	0.0	-0.1	0.0	0.0	0.0	-1.0	0.1	0.1	-0.1
0.6	0.1	0.0	-0.3	-0.1	0.0	0.0	0.0	0.0	0.2	0.2	0.1	0.1
0.7	0.0	0.2	-0.5	-0.2	0.0	0.0	0.0	0.0	-0.1	0.4	0.1	-0.3
0.8	0.1	0.1	-0.3	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.3	-0.2
0.9	0.0	0.1	-0.1	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	-0.5
Long Term												
Full Simulation Period ^b	0.1	0.1	-0.2	-0.2	-0.1	0.0	0.0	0.0	0.0	0.1	0.1	-0.1
Water Year Types ^c												
Wet (32%)	0.1	0.1	-0.2	-0.1	0.0	0.0	0.0	0.0	-0.1	0.0	0.3	-0.3
Above Normal (16%)	0.5	0.4	-0.1	-0.3	-0.1	0.0	0.0	0.0	-0.4	0.2	-0.1	-0.1
Below Normal (13%)	0.0	-0.1	-0.3	-0.3	-0.2	0.0	0.2	0.1	0.9	0.2	0.6	-0.3
Dry (24%)	-0.1	0.0	-0.1	-0.1	0.0	0.0	-0.1	-0.2	0.1	0.2	-0.1	0.1
Critical (15%)	-0.2	-0.2	-0.1	-0.2	-0.1	0.1	-0.1	0.4	-0.1	-0.2	-0.2	0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-12-5. American River below Nimbus Dam, Monthly Temperature

Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	66	58	53	48	49	52	58	63	67	69	67	68
20%	65	58	52	48	48	51	57	62	65	67	66	67
30%	64	58	51	47	48	51	56	60	65	65	66	66
40%	63	57	51	47	47	50	55	59	63	65	65	66
50%	63	57	50	46	47	49	54	58	63	64	64	65
60%	63	57	49	46	46	49	54	58	60	64	64	65
70%	63	56	49	46	46	49	53	57	60	64	63	65
80%	63	56	48	45	46	48	52	57	59	64	63	64
90%	59	56	47	45	45	48	52	55	59	63	62	64
Long Term												
Full Simulation Period ^b	63	57	50	46	47	50	55	59	62	65	65	66
Water Year Types^c												
Wet (32%)	60	54	48	46	46	49	53	57	60	64	63	64
Above Normal (16%)	63	57	50	47	47	49	54	58	62	64	64	65
Below Normal (13%)	62	57	51	47	47	50	56	60	63	65	65	66
Dry (24%)	64	57	51	47	47	51	56	60	64	66	66	66
Critical (15%)	65	58	51	47	48	52	57	61	66	69	67	68

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	66	58	53	48	49	52	58	63	68	69	67	68
20%	65	58	52	48	48	51	57	62	65	67	66	67
30%	64	58	52	47	48	51	56	61	65	65	66	67
40%	64	57	51	47	47	50	55	60	63	65	65	66
50%	63	57	50	46	47	49	55	58	62	65	64	65
60%	63	57	49	46	46	49	54	58	61	64	64	65
70%	63	57	49	46	46	49	53	57	60	64	63	65
80%	63	56	48	45	46	48	52	57	59	64	63	64
90%	59	56	47	45	45	48	52	55	59	63	62	63
Long Term												
Full Simulation Period ^b	63	57	50	46	47	50	55	59	63	65	65	66
Water Year Types^c												
Wet (32%)	60	54	48	46	46	49	53	57	60	64	63	64
Above Normal (16%)	64	57	50	46	47	49	54	58	62	64	64	65
Below Normal (13%)	62	57	51	47	47	50	56	61	63	65	65	66
Dry (24%)	64	57	51	47	47	51	56	60	64	66	66	66
Critical (15%)	65	58	51	47	48	52	57	61	66	69	67	68

Alternative 3 minus Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
0.1	0.4	0.0	-0.1	0.0	0.0	0.0	-0.1	0.3	0.9	-0.4	0.2	0.0
0.2	0.1	0.0	0.1	0.1	0.0	0.0	0.1	0.2	0.1	0.1	0.0	0.0
0.3	-0.1	0.0	0.2	0.0	-0.1	0.0	0.1	0.4	-0.2	0.1	0.0	0.1
0.4	0.1	-0.1	0.1	0.1	0.0	0.0	0.1	0.1	0.1	0.1	0.0	0.0
0.5	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	-0.2	0.1	0.0	0.0
0.6	0.1	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.3	0.1	0.1	0.1
0.7	0.0	0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	-0.1	0.0
0.8	0.0	0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	-0.3
0.9	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	-0.2
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.0	0.0
Water Year Types^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0
Above Normal (16%)	0.3	0.2	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0
Below Normal (13%)	0.1	0.2	0.0	0.0	0.0	0.0	0.1	0.5	0.6	0.1	0.3	0.2
Dry (24%)	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.1	0.1	0.2	0.0	-0.1
Critical (15%)	-0.1	-0.1	-0.1	0.0	0.0	-0.1	0.0	0.0	-0.2	-0.1	-0.2	0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-12-6. American River below Nimbus Dam, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	66	58	53	48	49	52	58	63	67	69	67	68
20%	65	58	52	48	48	51	57	62	65	67	66	67
30%	64	58	51	47	48	51	56	60	65	65	66	66
40%	63	57	51	47	47	50	55	59	63	65	65	66
50%	63	57	50	46	47	49	54	58	63	64	64	65
60%	63	57	49	46	46	49	54	58	60	64	64	65
70%	63	56	49	46	46	49	53	57	60	64	63	65
80%	63	56	48	45	46	48	52	57	59	64	63	64
90%	59	56	47	45	45	48	52	55	59	63	62	64
Long Term												
Full Simulation Period ^b	63	57	50	46	47	50	55	59	62	65	65	66
Water Year Types ^c												
Wet (32%)	60	54	48	46	46	49	53	57	60	64	63	64
Above Normal (16%)	63	57	50	47	47	49	54	58	62	64	64	65
Below Normal (13%)	62	57	51	47	47	50	56	60	63	65	65	66
Dry (24%)	64	57	51	47	47	51	56	60	64	66	66	66
Critical (15%)	65	58	51	47	48	52	57	61	66	69	67	68

Alternative 5

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	66	58	53	48	49	52	58	63	68	68	67	68
20%	65	58	52	47	48	52	57	62	66	67	67	68
30%	64	58	51	47	47	51	56	61	65	65	66	67
40%	64	57	51	47	47	50	55	60	63	65	65	66
50%	63	57	50	46	47	49	55	58	62	65	64	65
60%	63	57	49	46	46	49	54	58	61	64	64	65
70%	63	57	48	45	46	49	53	57	60	64	63	64
80%	63	56	48	45	46	48	52	57	59	64	63	64
90%	59	56	47	44	45	48	52	55	59	64	63	63
Long Term												
Full Simulation Period ^b	63	57	50	46	47	50	55	59	63	65	65	66
Water Year Types ^c												
Wet (32%)	60	55	47	46	46	49	53	57	60	64	63	64
Above Normal (16%)	64	57	50	46	47	49	54	58	62	64	64	65
Below Normal (13%)	62	57	51	46	47	50	56	60	64	65	65	66
Dry (24%)	64	57	51	47	47	51	55	60	64	66	66	66
Critical (15%)	65	57	51	47	48	52	57	62	66	68	67	68

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.4	0.0	-0.1	-0.4	-0.2	0.3	-0.2	-0.1	0.7	-0.7	0.2	0.4
0.2	0.2	0.0	0.0	-0.2	0.0	0.3	0.1	-0.1	0.7	0.1	0.5	0.2
0.3	-0.1	0.0	-0.3	-0.3	-0.2	-0.1	-0.1	0.3	-0.2	0.1	0.1	0.1
0.4	0.0	-0.1	0.1	0.0	-0.2	0.0	0.1	0.1	0.1	0.2	0.1	-0.2
0.5	0.0	0.0	0.1	0.0	-0.1	0.0	0.0	0.0	-0.7	0.1	-0.1	-0.1
0.6	0.1	-0.1	-0.3	-0.1	0.0	0.0	0.0	0.0	0.2	0.2	-0.1	-0.1
0.7	0.0	0.1	-0.4	-0.2	0.0	0.0	0.0	0.0	-0.1	0.3	0.1	-0.2
0.8	0.1	0.0	-0.4	-0.1	0.0	0.0	0.0	0.0	0.0	-0.1	0.4	-0.3
0.9	0.1	0.0	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.4	-0.6
Long Term												
Full Simulation Period ^b	0.0	0.0	-0.2	-0.2	-0.1	0.0	0.0	0.0	0.1	0.0	0.2	-0.1
Water Year Types ^c												
Wet (32%)	0.1	0.1	-0.2	-0.1	0.0	0.0	0.0	0.0	-0.1	0.0	0.3	-0.3
Above Normal (16%)	0.5	0.2	-0.1	-0.3	-0.1	0.0	0.0	0.0	-0.4	0.2	-0.1	-0.1
Below Normal (13%)	0.0	-0.1	-0.5	-0.5	-0.2	0.0	0.2	0.1	0.9	0.1	0.7	-0.2
Dry (24%)	-0.1	0.0	0.0	-0.1	0.0	0.0	-0.1	-0.1	0.2	0.1	0.0	0.1
Critical (15%)	-0.2	-0.3	-0.2	-0.2	-0.1	0.2	-0.2	0.3	0.0	-0.8	0.0	0.4

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


B.13. American River at Watt Avenue Temperature

Figure B-13-1. American River at Watt Avenue, October

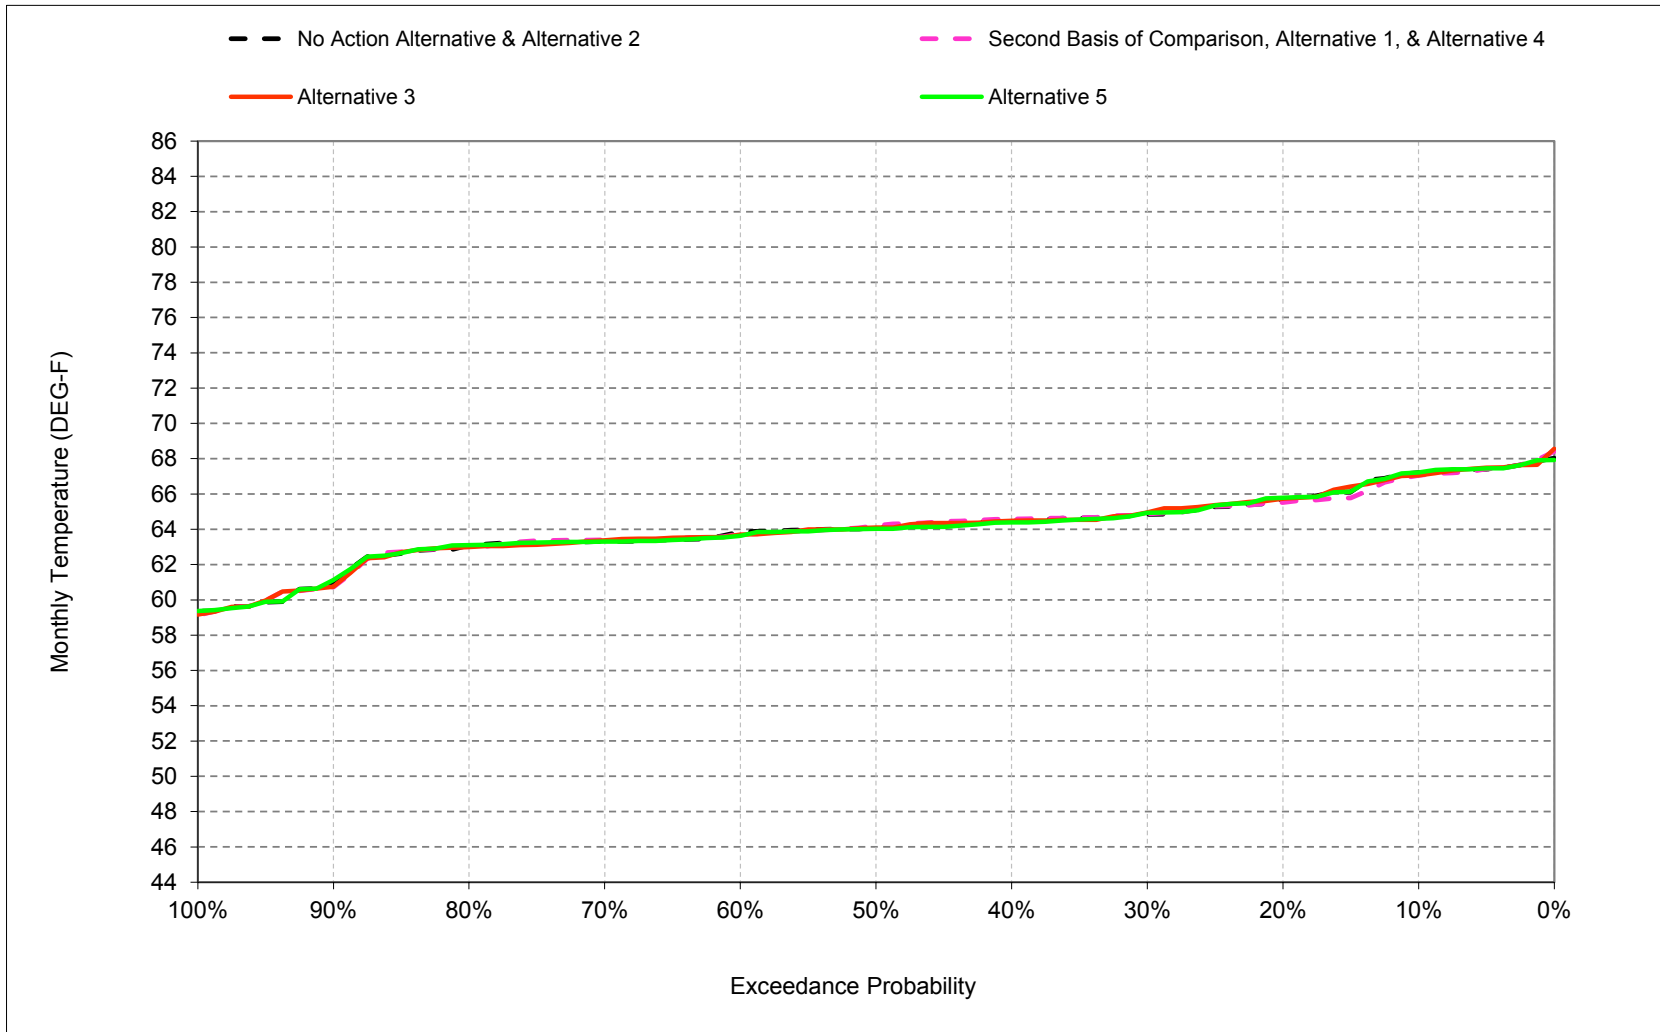


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-13-2. American River at Watt Avenue, November

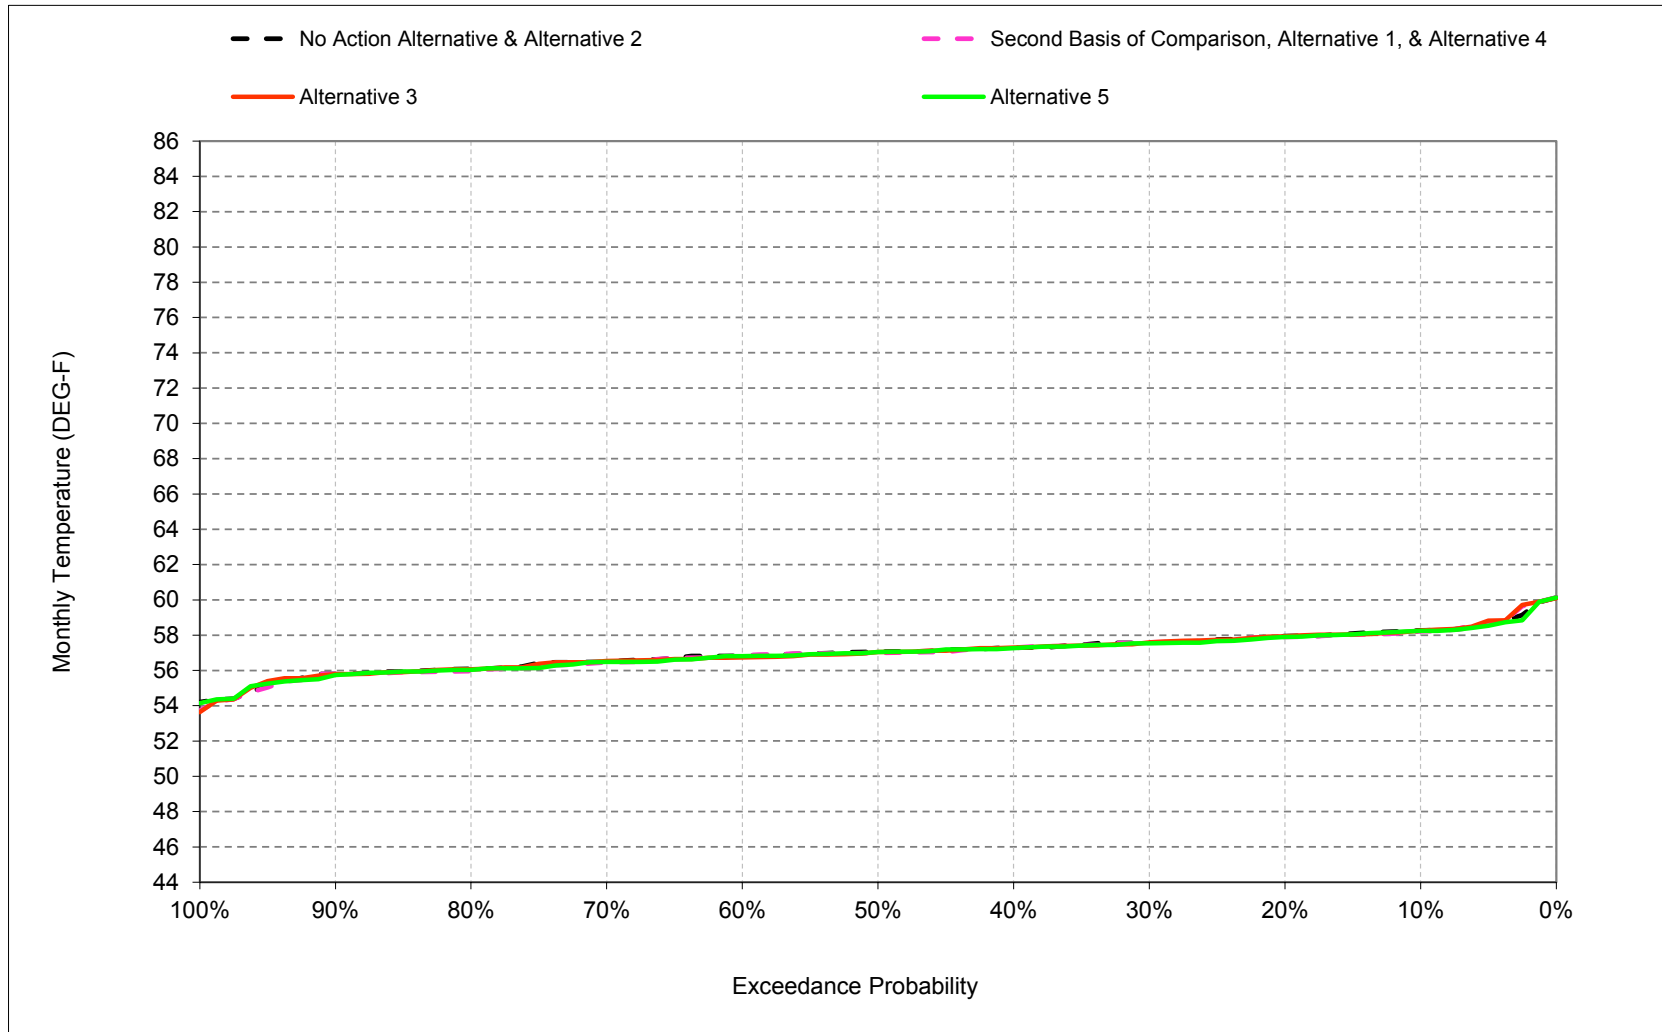


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-13-3. American River at Watt Avenue, December

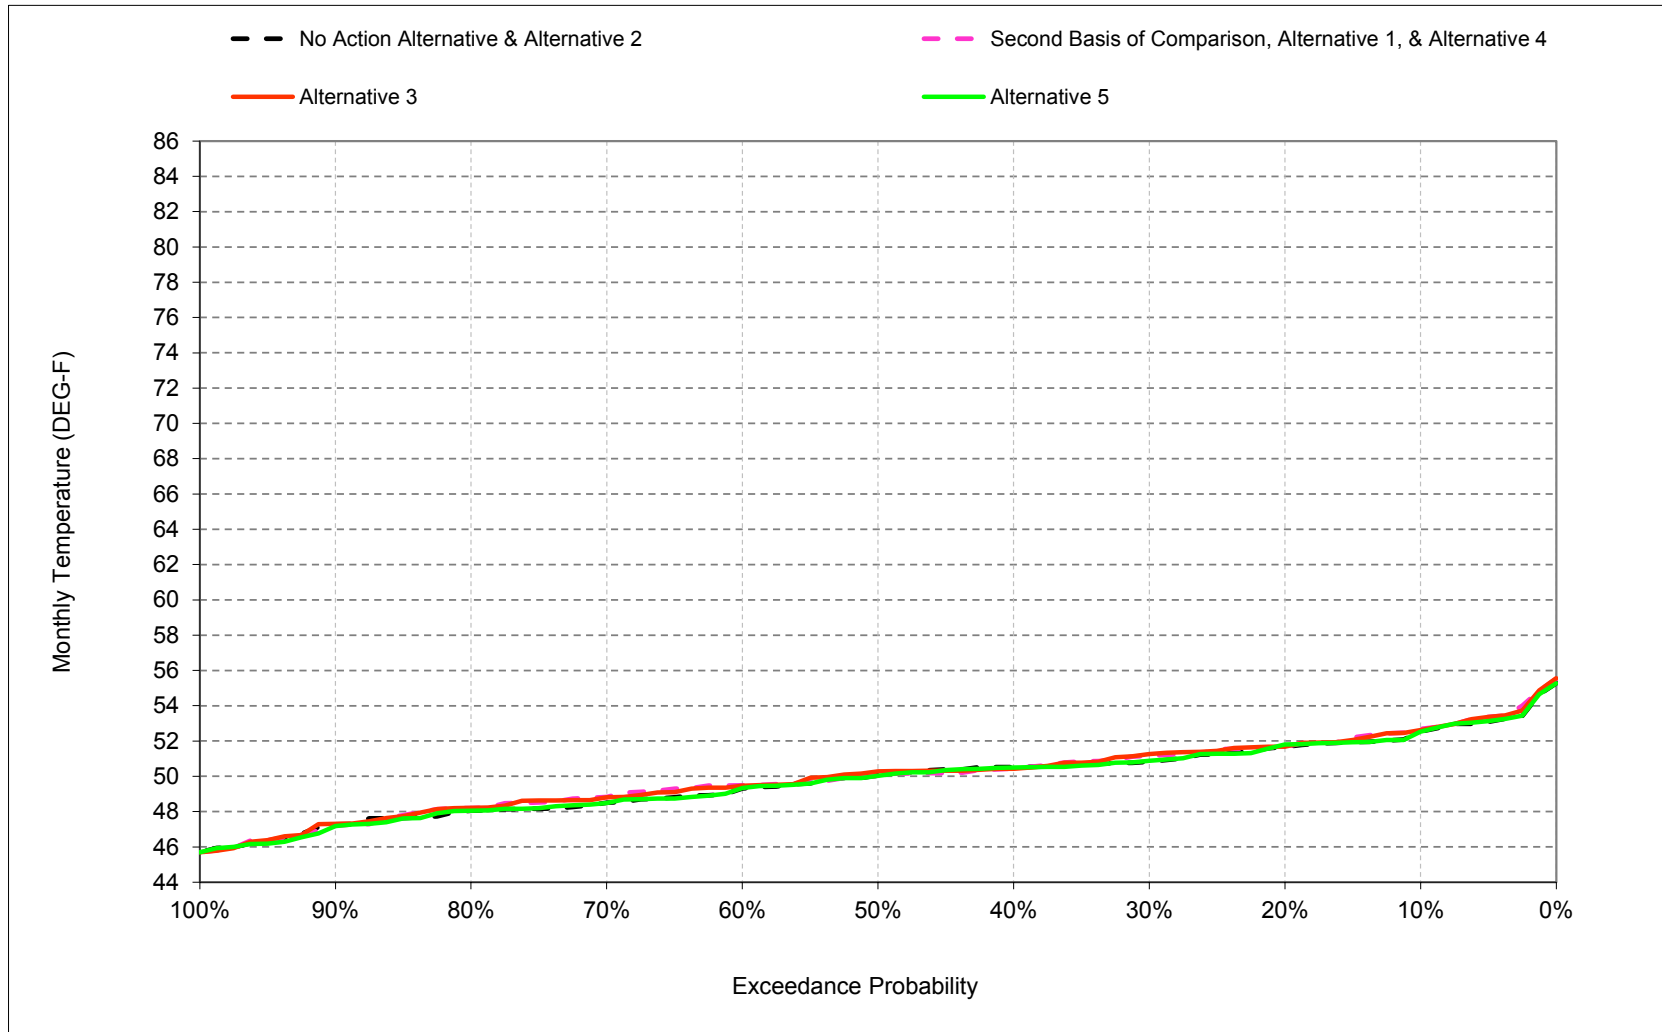


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-13-4. American River at Watt Avenue, January

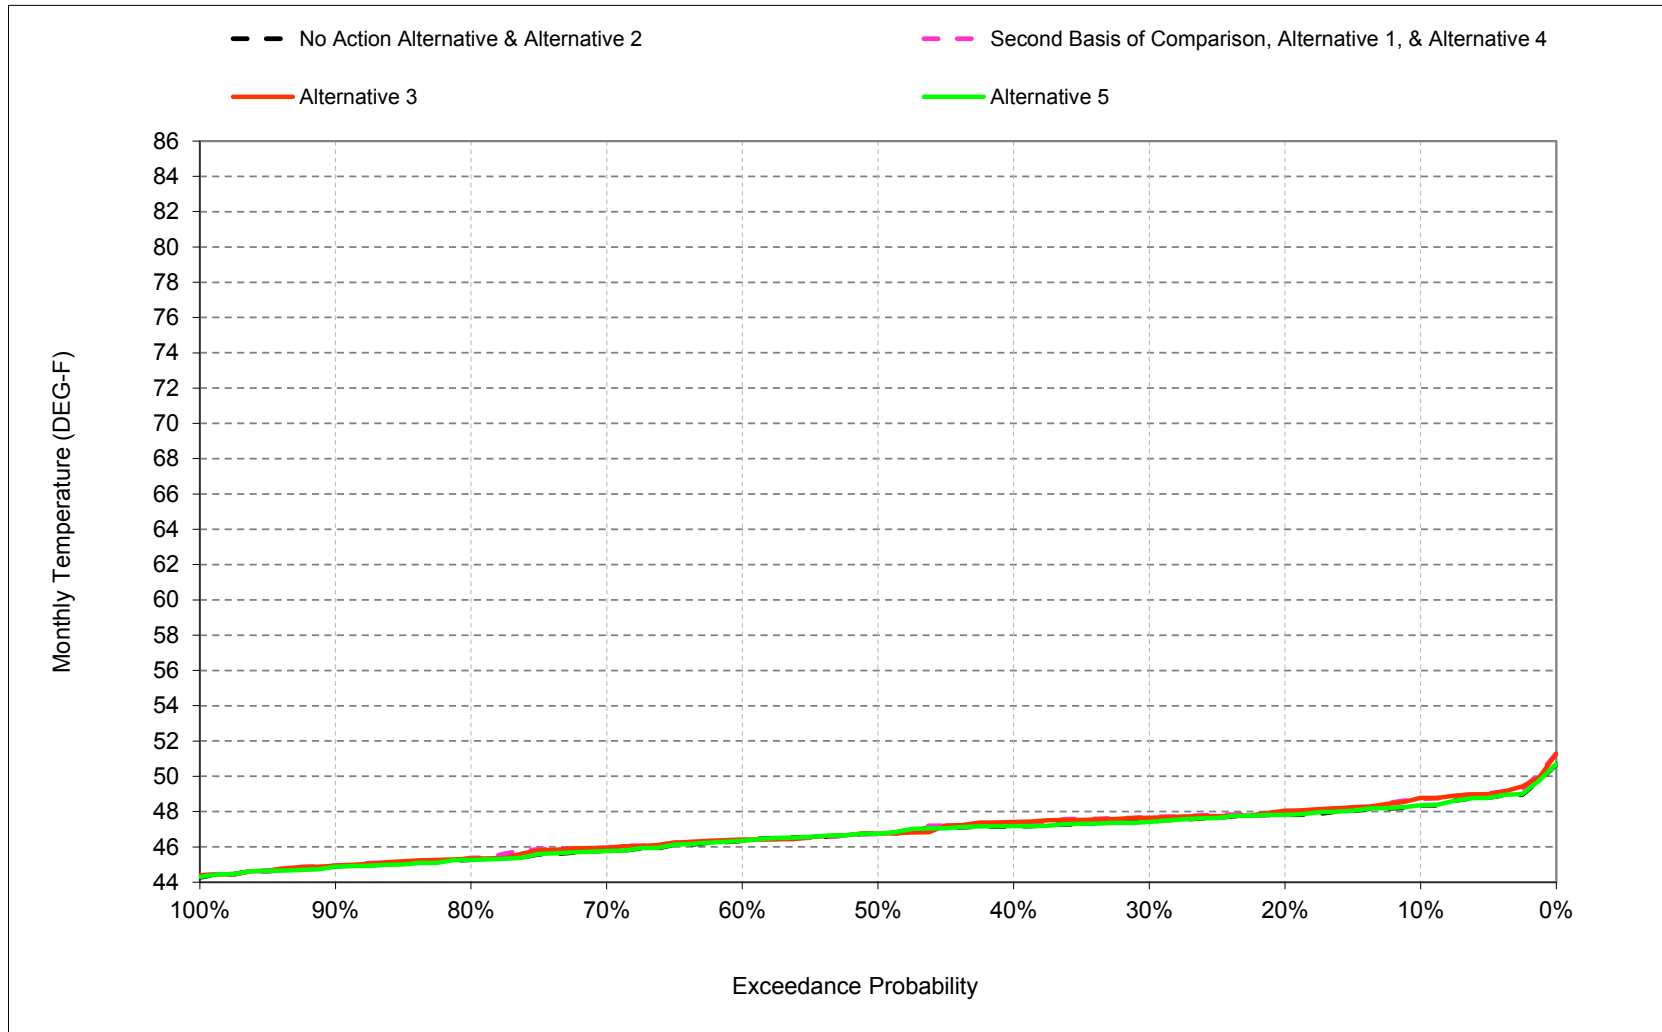


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-13-5. American River at Watt Avenue, February

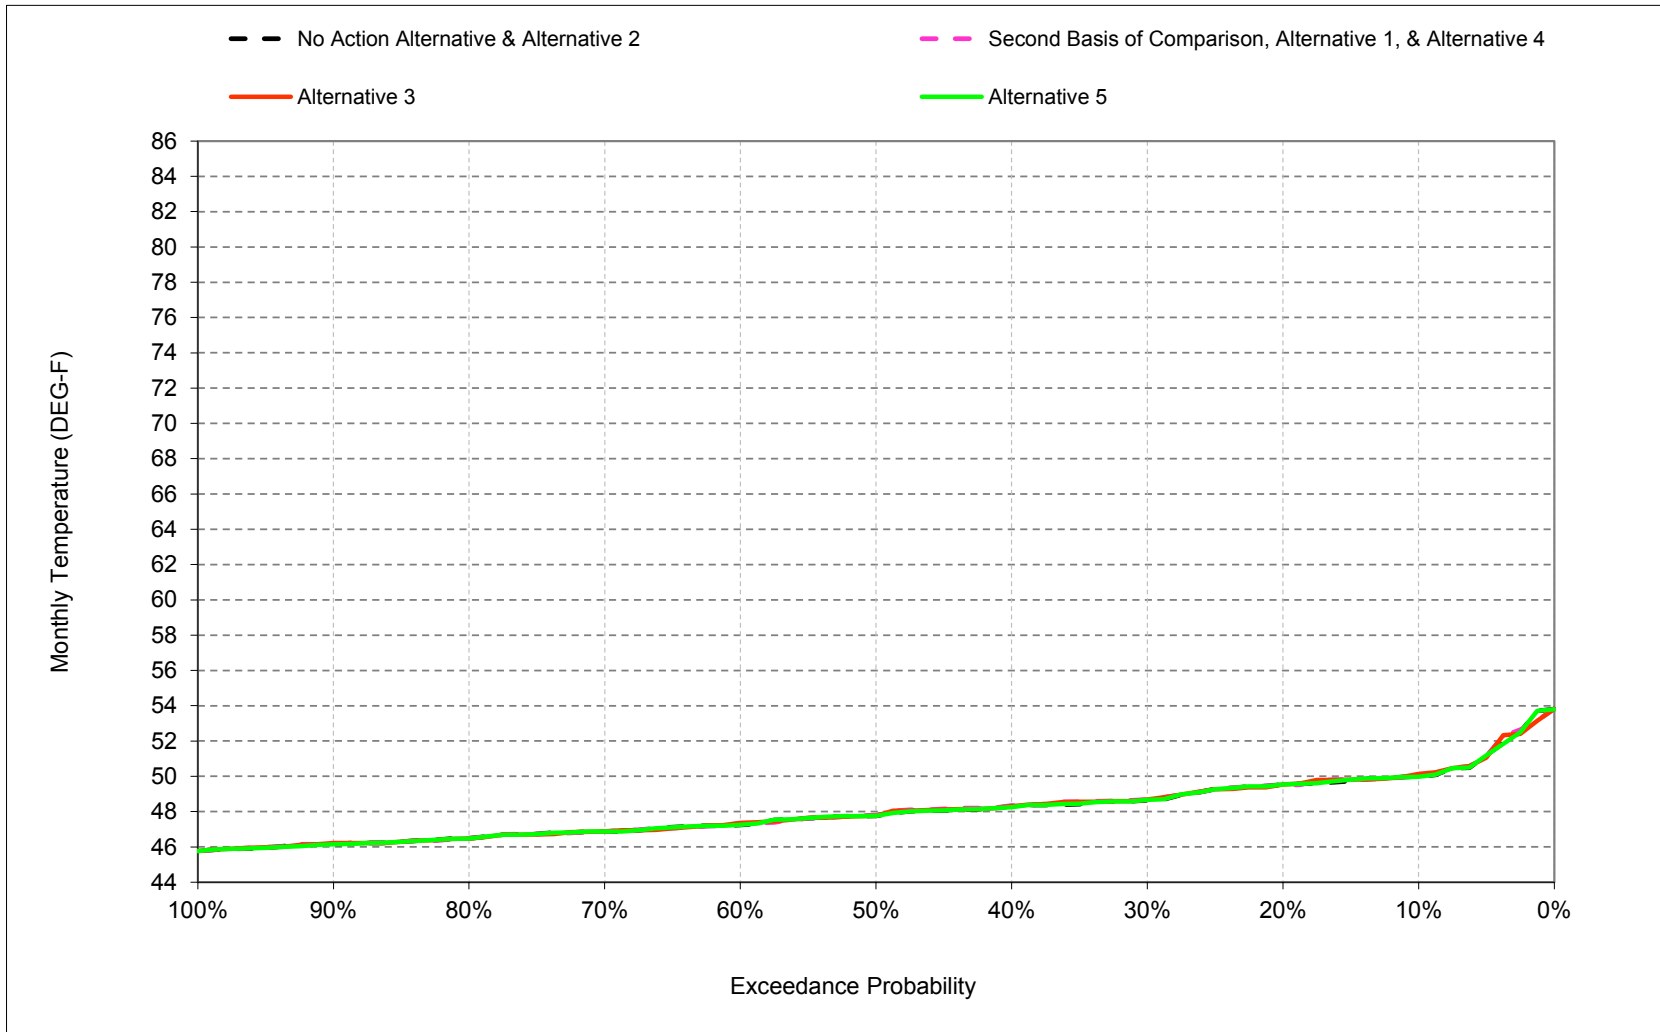


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-13-6. American River at Watt Avenue, March

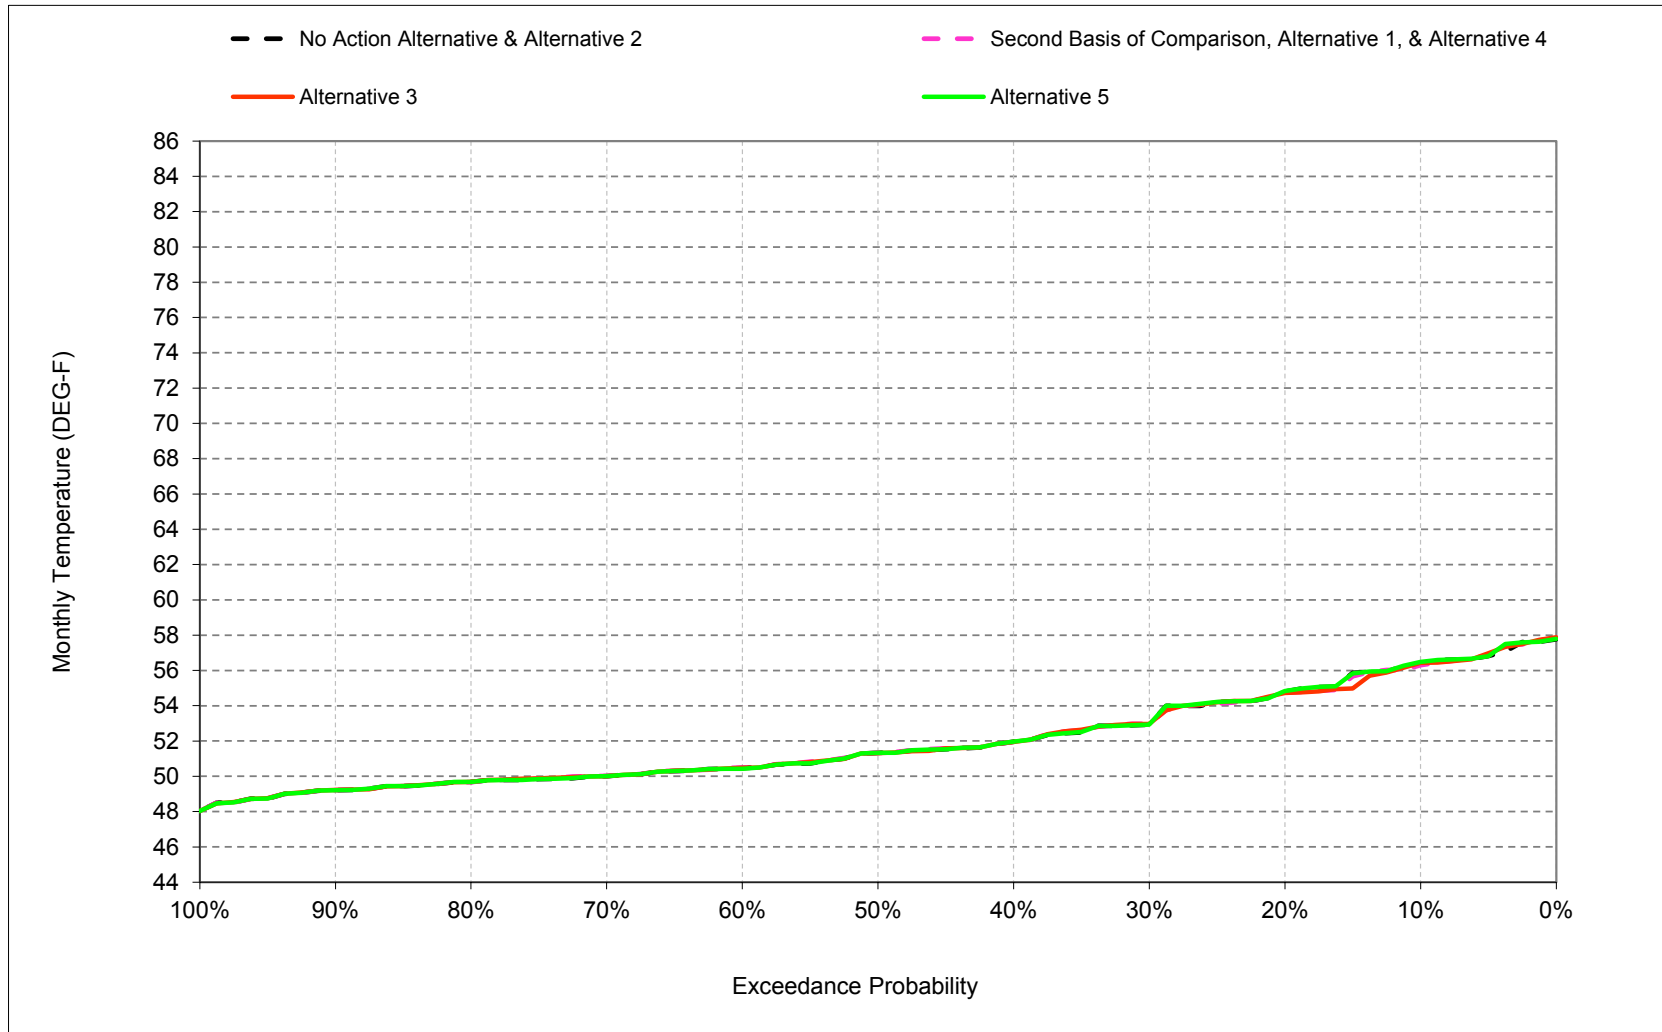


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-13-7. American River at Watt Avenue, April

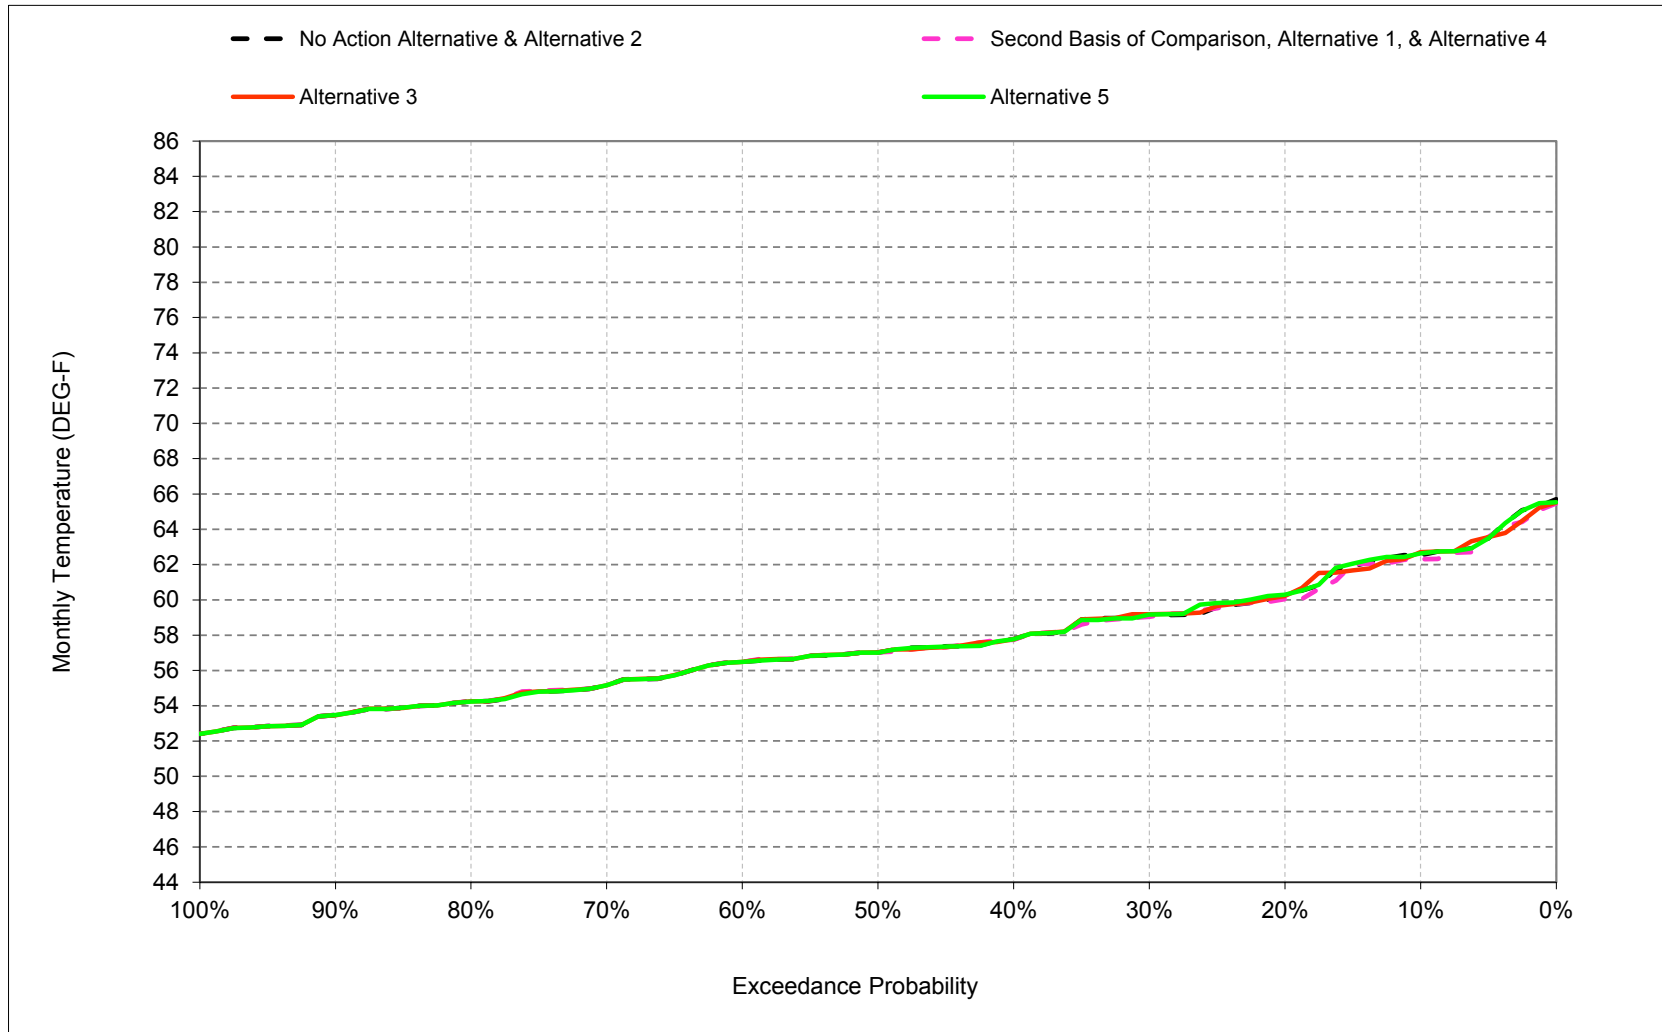


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-13-8. American River at Watt Avenue, May

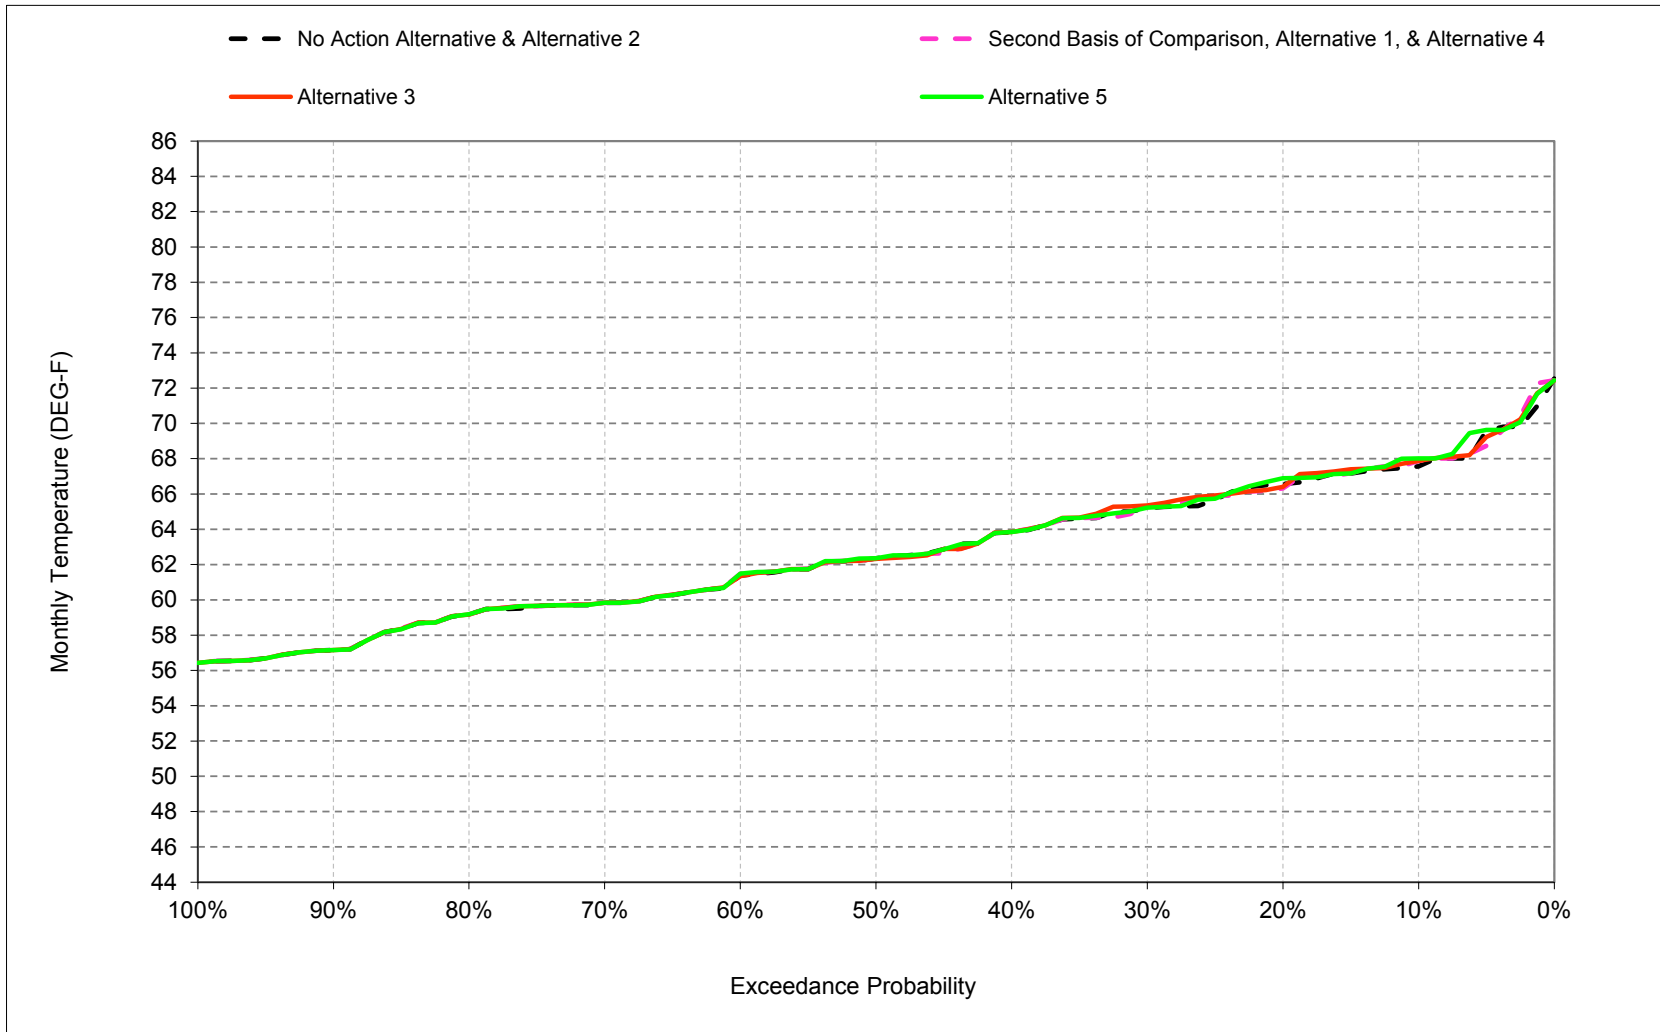


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-13-9. American River at Watt Avenue, June

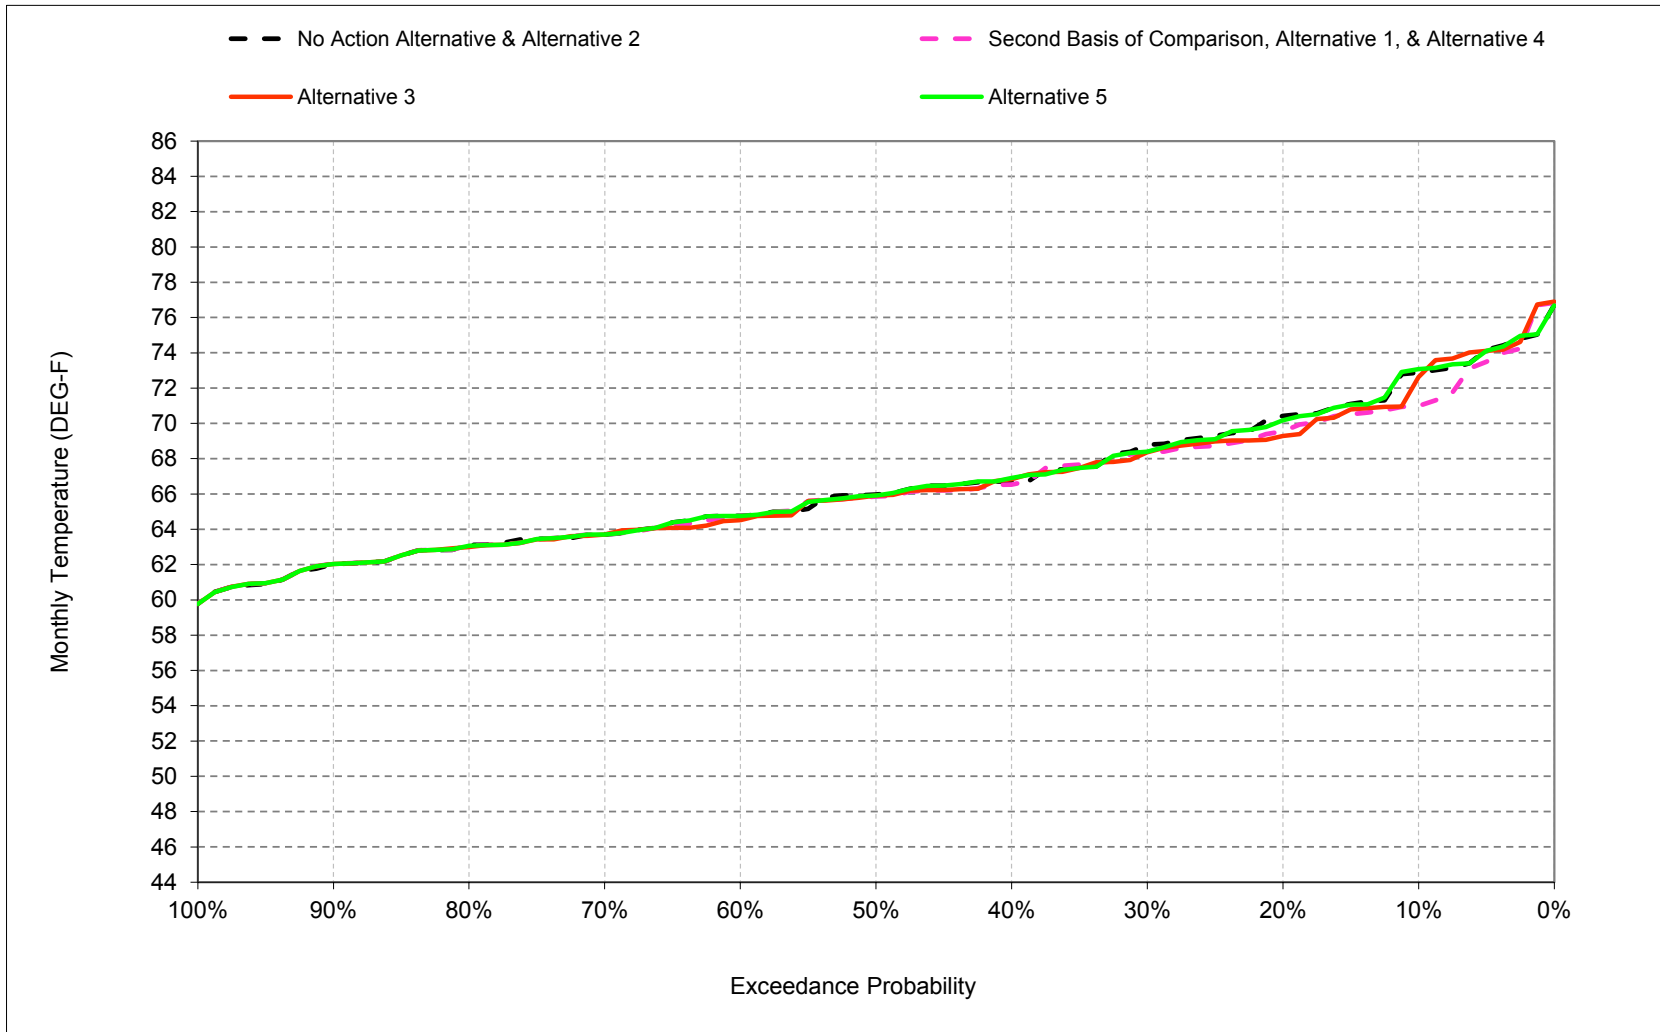


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-13-10. American River at Watt Avenue, July

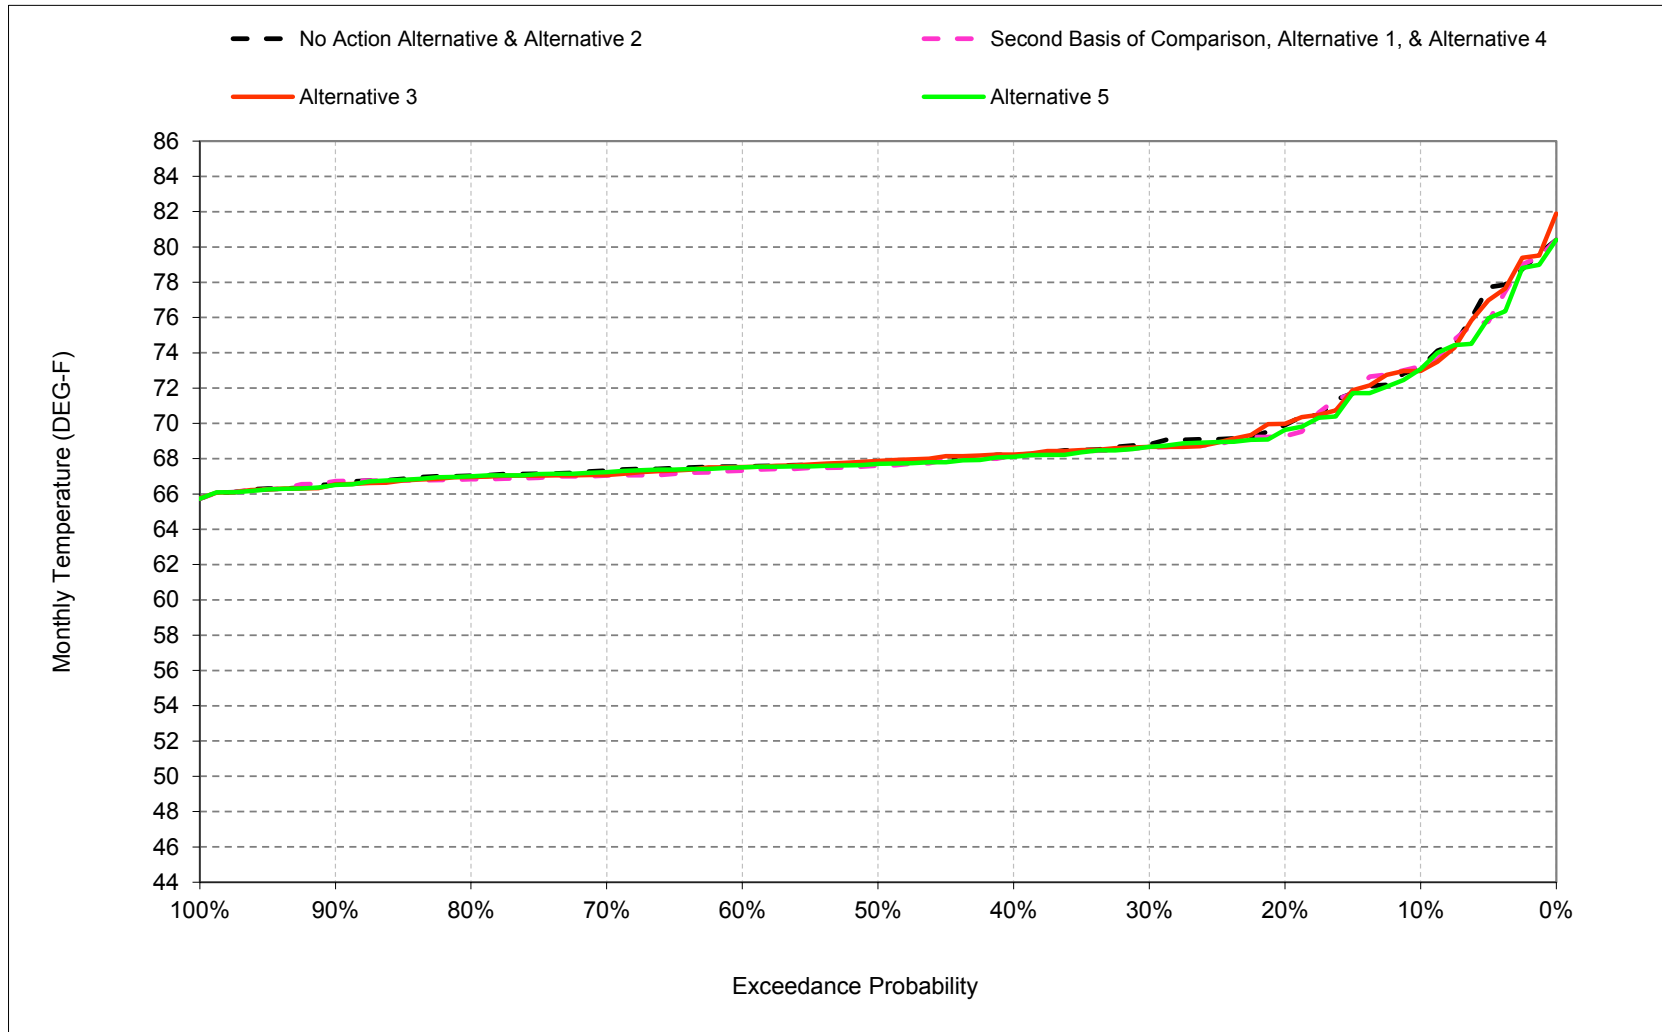


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-13-11. American River at Watt Avenue, August

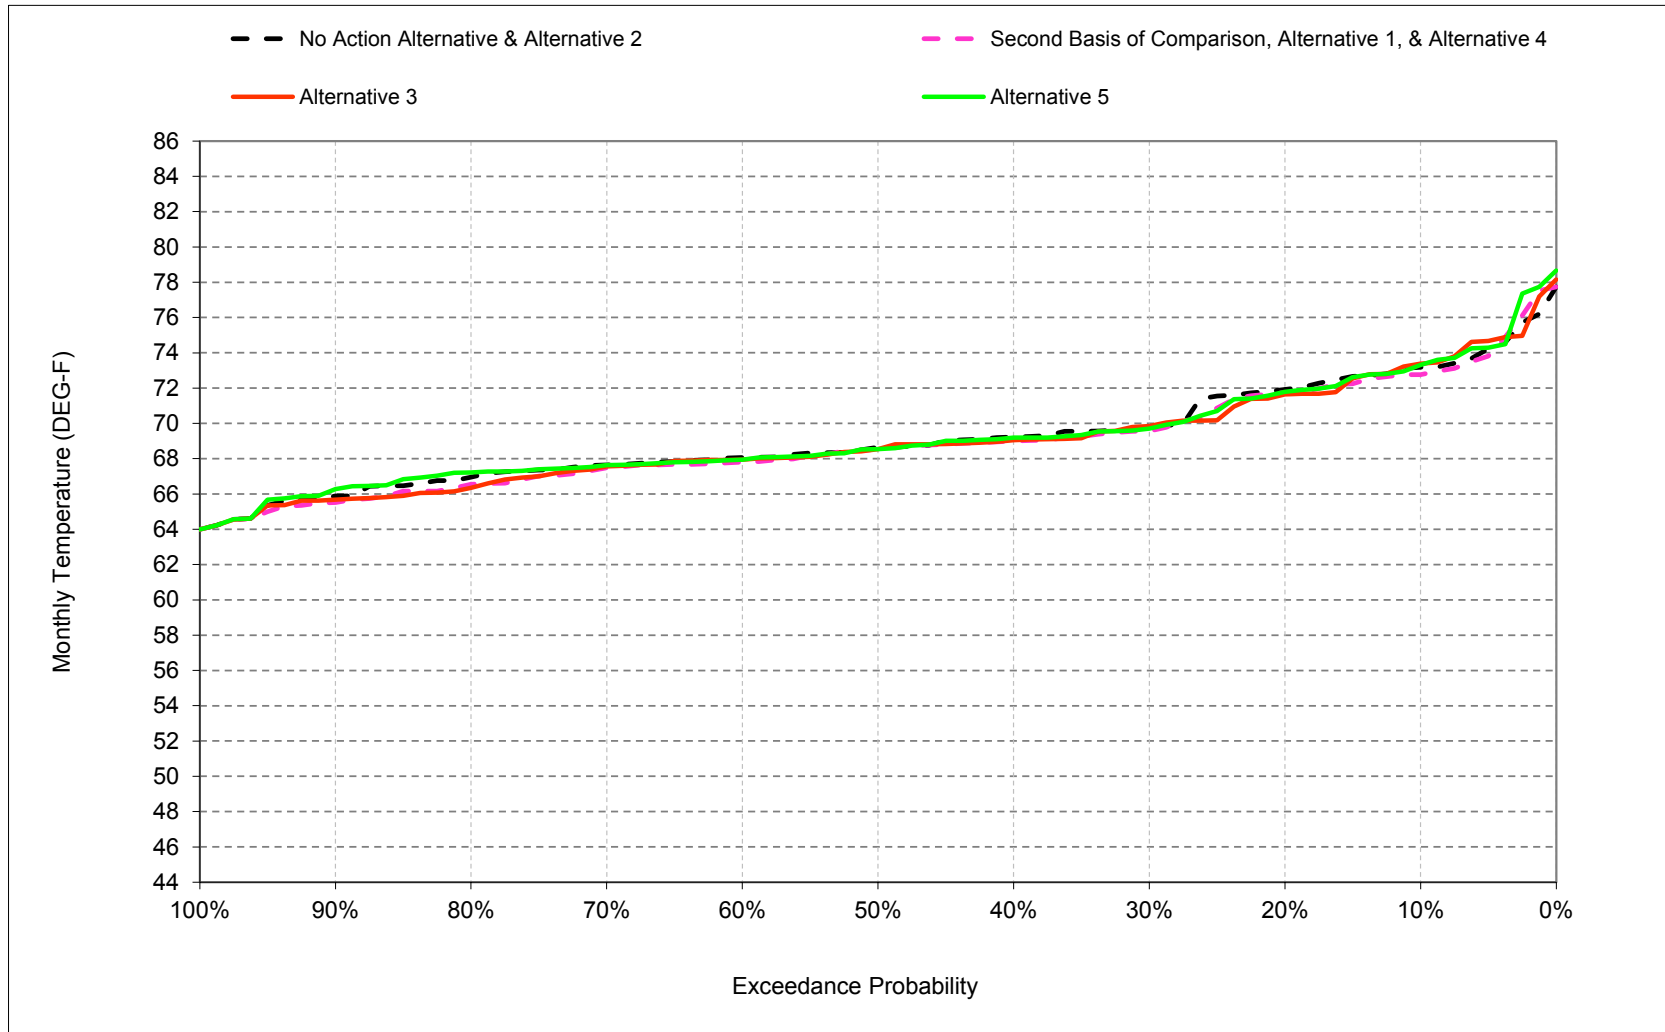

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-13-12. American River at Watt Avenue, September

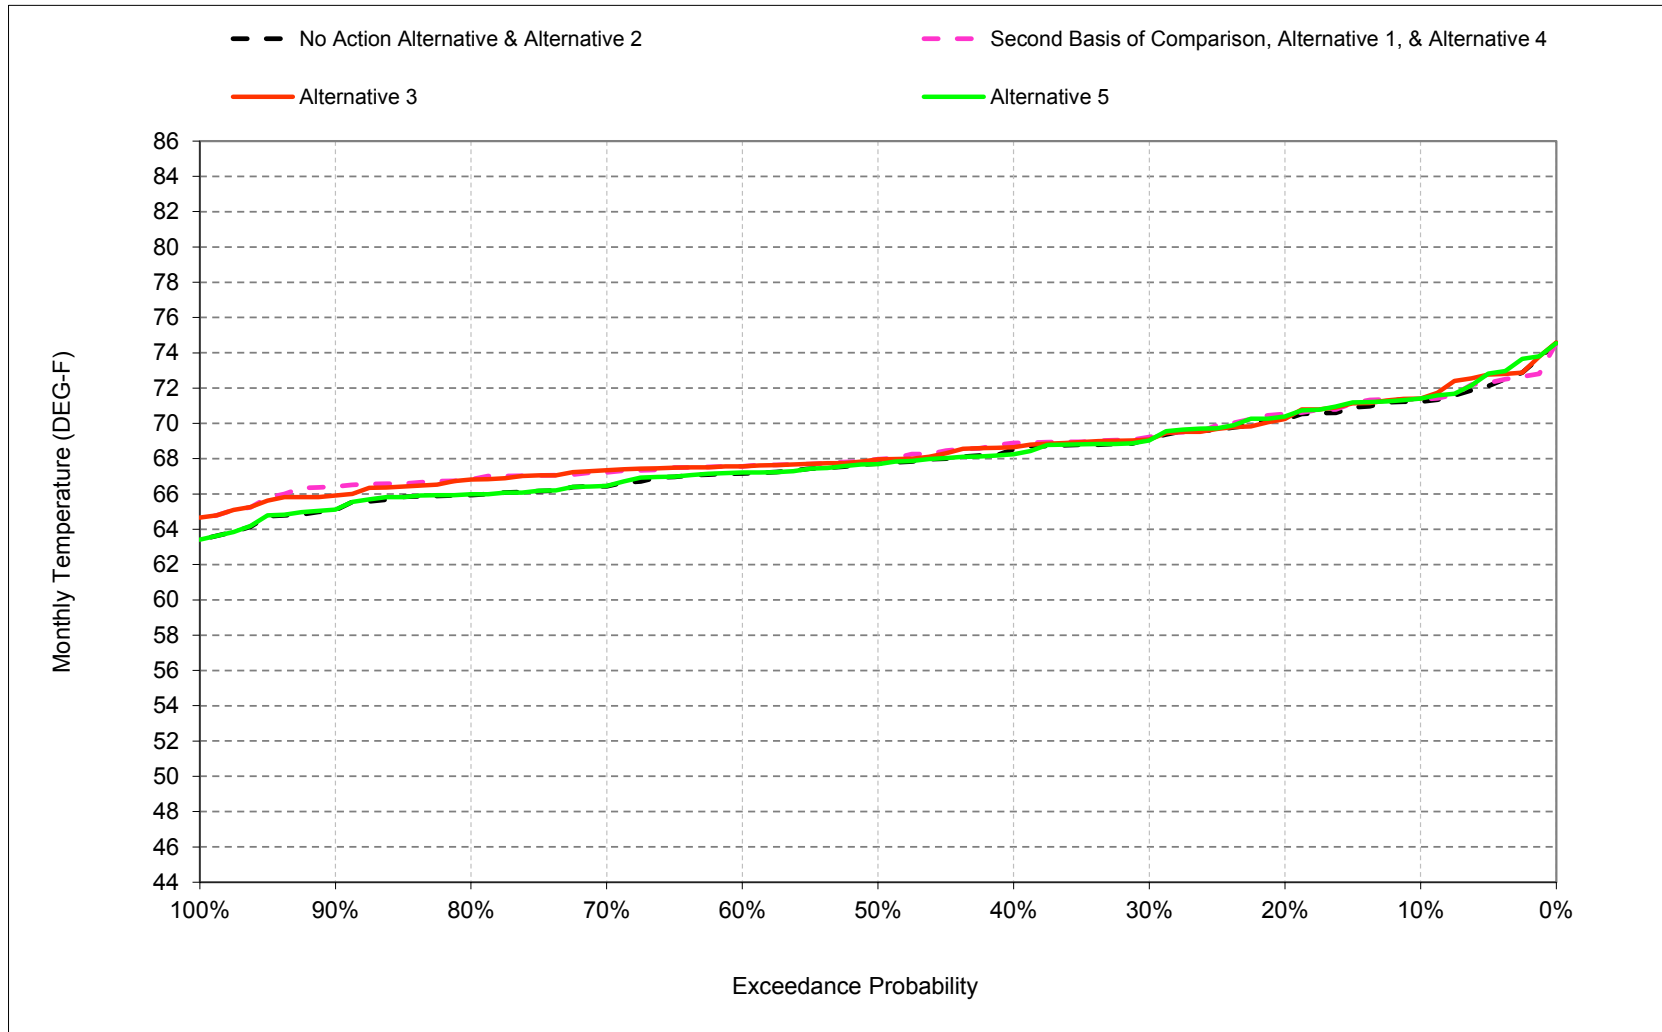

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-13-1. American River at Watt Avenue, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	67	58	53	48	50	56	63	68	73	73	73	71
20%	66	58	52	48	50	55	60	67	70	70	72	70
30%	65	58	51	47	49	53	59	65	69	69	70	69
40%	64	57	51	47	48	52	58	64	67	68	69	68
50%	64	57	50	47	48	51	57	62	66	68	69	68
60%	64	57	49	46	47	50	56	61	65	68	68	67
70%	63	56	49	46	47	50	55	60	64	67	68	66
80%	63	56	48	45	46	50	54	59	63	67	67	66
90%	61	56	47	45	46	49	53	57	62	67	66	65
Long Term												
Full Simulation Period ^b	64	57	50	47	48	52	57	63	66	69	69	68
Water Year Types ^c												
Wet (32%)	61	55	47	46	47	50	55	59	63	67	67	66
Above Normal (16%)	65	57	50	47	47	50	56	62	66	67	68	67
Below Normal (13%)	63	56	50	47	48	52	59	64	68	68	70	69
Dry (24%)	64	57	50	47	49	53	58	64	68	69	70	69
Critical (15%)	66	58	50	47	51	56	61	67	70	74	72	71

Alternative 1												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	67	58	53	49	50	56	62	68	71	73	73	71
20%	66	58	52	48	49	55	60	66	70	69	72	71
30%	65	58	51	48	49	53	59	65	68	69	70	69
40%	65	57	50	47	48	52	58	64	67	68	69	69
50%	64	57	50	47	48	51	57	62	66	68	69	68
60%	64	57	49	46	47	50	56	61	65	67	68	68
70%	63	56	49	46	47	50	55	60	64	67	67	67
80%	63	56	48	45	46	50	54	59	63	67	66	67
90%	61	56	47	45	46	49	53	57	62	67	65	66
Long Term												
Full Simulation Period ^b	64	57	50	47	48	52	57	63	66	69	69	68
Water Year Types ^c												
Wet (32%)	61	55	47	46	47	50	55	59	63	67	66	67
Above Normal (16%)	64	57	50	47	47	50	56	62	66	67	68	68
Below Normal (13%)	63	56	51	47	48	52	59	64	68	68	69	69
Dry (24%)	65	57	50	47	49	53	59	64	68	69	70	69
Critical (15%)	66	58	50	47	51	56	61	66	71	74	72	71

Alternative 1 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.2	0.0	0.2	0.4	0.1	-0.1	-0.2	0.3	-1.9	0.1	-0.4	0.1
0.2	-0.2	-0.1	0.0	0.1	0.0	-0.1	-0.2	-0.3	-0.9	-0.6	-0.2	0.3
0.3	0.0	0.0	0.3	0.3	0.0	0.1	-0.1	0.0	-0.3	-0.2	-0.2	0.1
0.4	0.1	0.0	-0.1	0.2	0.0	0.0	0.0	0.0	-0.2	-0.1	-0.2	0.4
0.5	0.1	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.2	-0.1	0.2
0.6	-0.1	0.0	0.2	0.0	0.1	0.0	0.0	0.1	-0.1	-0.2	-0.3	0.4
0.7	0.1	0.0	0.3	0.2	0.0	0.0	0.0	0.0	0.0	-0.3	-0.3	0.8
0.8	-0.1	-0.1	0.2	0.0	0.0	0.0	0.0	0.0	0.0	-0.2	-0.4	0.8
0.9	-0.2	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.1	-0.2	1.4
Long Term												
Full Simulation Period ^b	0.0	0.0	0.2	0.1	0.0	0.0	-0.1	0.0	-0.2	-0.2	-0.2	0.5
Water Year Types ^c												
Wet (32%)	-0.1	-0.1	0.2	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.5	1.1
Above Normal (16%)	-0.2	-0.3	0.1	0.2	0.0	0.0	0.0	0.0	-0.1	-0.2	0.1	0.5
Below Normal (13%)	0.1	0.1	0.3	0.3	0.0	0.0	-0.3	0.1	-1.6	-0.3	-0.6	0.2
Dry (24%)	0.1	0.0	0.1	0.1	0.0	0.0	0.0	0.1	-0.2	-0.3	0.1	0.0
Critical (15%)	0.1	0.2	0.1	0.1	0.0	0.0	-0.2	-0.2	0.5	0.1	-0.1	0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-13-2. American River at Watt Avenue, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	67	58	53	48	50	56	63	68	73	73	73	71
20%	66	58	52	48	50	55	60	67	70	70	72	70
30%	65	58	51	47	49	53	59	65	69	69	70	69
40%	64	57	51	47	48	52	58	64	67	68	69	68
50%	64	57	50	47	48	51	57	62	66	68	69	68
60%	64	57	49	46	47	50	56	61	65	68	68	67
70%	63	56	49	46	47	50	55	60	64	67	68	66
80%	63	56	48	45	46	50	54	59	63	67	67	66
90%	61	56	47	45	46	49	53	57	62	67	66	65
Long Term												
Full Simulation Period ^b	64	57	50	47	48	52	57	63	66	69	69	68
Water Year Types ^c												
Wet (32%)	61	55	47	46	47	50	55	59	63	67	67	66
Above Normal (16%)	65	57	50	47	47	50	56	62	66	67	68	67
Below Normal (13%)	63	56	50	47	48	52	59	64	68	68	70	69
Dry (24%)	64	57	50	47	49	53	58	64	68	69	70	69
Critical (15%)	66	58	50	47	51	56	61	67	70	74	72	71

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	67	58	53	49	50	56	63	68	72	73	73	71
20%	66	58	52	48	50	55	60	66	69	70	72	70
30%	65	58	51	48	49	53	59	65	68	69	70	69
40%	64	57	50	47	48	52	58	64	67	68	69	69
50%	64	57	50	47	48	51	57	62	66	68	68	68
60%	64	57	49	46	47	50	56	61	64	68	68	68
70%	63	57	49	46	47	50	55	60	64	67	67	67
80%	63	56	48	45	46	50	54	59	63	67	66	67
90%	61	56	47	45	46	49	53	57	62	66	66	66
Long Term												
Full Simulation Period ^b	64	57	50	47	48	52	57	63	66	69	69	68
Water Year Types ^c												
Wet (32%)	61	54	48	46	47	50	55	59	63	67	66	67
Above Normal (16%)	65	57	50	47	47	50	56	62	66	67	68	68
Below Normal (13%)	63	57	51	47	48	52	59	64	67	68	69	69
Dry (24%)	65	57	50	47	49	53	59	64	68	69	70	69
Critical (15%)	66	58	50	47	51	55	61	66	71	74	73	71

Alternative 3 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.2	0.0	0.1	0.4	0.1	0.0	0.1	0.3	-0.4	-0.2	0.2	0.2
0.2	0.0	0.0	0.0	0.2	0.0	0.0	0.0	-0.2	-1.1	0.1	-0.3	0.0
0.3	0.1	0.0	0.4	0.2	0.0	0.0	0.1	0.2	-0.4	-0.1	0.1	0.0
0.4	0.0	0.0	-0.1	0.3	0.0	0.0	0.0	0.0	0.1	0.0	-0.2	0.2
0.5	0.0	0.0	0.2	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	-0.1	0.2
0.6	-0.2	-0.1	0.2	0.1	0.1	0.0	0.0	0.0	-0.3	0.0	-0.1	0.4
0.7	0.1	0.1	0.3	0.2	0.0	0.0	0.0	0.0	-0.1	-0.2	-0.2	0.9
0.8	-0.1	0.0	0.2	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.6	0.8
0.9	-0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.2	-0.1	0.8
Long Term												
Full Simulation Period ^b	0.0	0.0	0.2	0.1	0.0	0.0	0.0	0.1	-0.1	0.0	-0.2	0.4
Water Year Types ^c												
Wet (32%)	0.0	-0.1	0.2	0.1	0.0	0.0	0.0	0.0	-0.1	0.1	-0.4	1.0
Above Normal (16%)	-0.1	-0.2	0.0	0.1	0.0	0.0	0.0	0.0	-0.2	-0.2	0.3	0.6
Below Normal (13%)	0.1	0.3	0.4	0.3	0.1	0.0	-0.1	0.1	-0.5	-0.1	-0.6	0.1
Dry (24%)	0.1	0.0	0.1	0.1	0.0	0.0	0.1	0.2	-0.1	0.0	-0.1	-0.1
Critical (15%)	0.0	0.1	0.1	0.1	0.0	-0.1	0.0	-0.2	0.3	0.0	0.1	0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-13-3. American River at Watt Avenue, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	67	58	53	48	50	56	63	68	73	73	73	71
20%	66	58	52	48	50	55	60	67	70	70	72	70
30%	65	58	51	47	49	53	59	65	69	69	70	69
40%	64	57	51	47	48	52	58	64	67	68	69	68
50%	64	57	50	47	48	51	57	62	66	68	69	68
60%	64	57	49	46	47	50	56	61	65	68	68	67
70%	63	56	49	46	47	50	55	60	64	67	68	66
80%	63	56	48	45	46	50	54	59	63	67	67	66
90%	61	56	47	45	46	49	53	57	62	67	66	65
Long Term												
Full Simulation Period ^b	64	57	50	47	48	52	57	63	66	69	69	68
Water Year Types ^c												
Wet (32%)	61	55	47	46	47	50	55	59	63	67	67	66
Above Normal (16%)	65	57	50	47	47	50	56	62	66	67	68	67
Below Normal (13%)	63	56	50	47	48	52	59	64	68	68	70	69
Dry (24%)	64	57	50	47	49	53	58	64	68	69	70	69
Critical (15%)	66	58	50	47	51	56	61	67	70	74	72	71

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	67	58	53	48	50	56	63	68	73	73	73	71
20%	66	58	52	48	50	55	60	67	70	70	72	70
30%	65	58	51	47	49	53	59	65	68	69	70	69
40%	64	57	51	47	48	52	58	64	67	68	69	68
50%	64	57	50	47	48	51	57	62	66	68	69	68
60%	64	57	49	46	47	50	56	61	65	67	68	67
70%	63	56	48	46	47	50	55	60	64	67	68	66
80%	63	56	48	45	46	50	54	59	63	67	67	66
90%	61	56	47	45	46	49	53	57	62	66	66	65
Long Term												
Full Simulation Period ^b	64	57	50	47	48	52	57	63	66	69	69	68
Water Year Types ^c												
Wet (32%)	61	55	47	46	47	50	55	59	63	67	67	66
Above Normal (16%)	65	57	50	47	47	50	56	62	66	67	68	67
Below Normal (13%)	63	56	50	47	48	52	59	64	68	68	70	69
Dry (24%)	64	57	50	47	49	53	58	64	68	69	70	69
Critical (15%)	66	58	50	47	51	56	61	67	70	74	72	72

Alternative 5 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.5	0.2	-0.1	0.1	0.2
0.2	0.0	-0.1	0.1	0.0	0.0	0.0	0.0	0.3	-0.3	-0.3	-0.2	0.2
0.3	0.1	0.0	0.1	0.0	0.0	0.0	0.0	0.0	-0.3	-0.1	-0.1	-0.1
0.4	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	-0.1	-0.2
0.5	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	-0.1	0.0	0.0
0.6	-0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.0
0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.0
0.8	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.4	0.0
0.9	0.1	-0.1	-0.1	-0.1	0.0	0.0	0.0	0.0	0.1	-0.1	0.2	0.1
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	-0.2	0.0	0.1
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.0
Above Normal (16%)	0.0	-0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	-0.1	-0.1	0.0	0.0	0.0	0.1	0.1	-0.1	0.1	0.1
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.1	-0.2	0.0	0.0
Critical (15%)	0.0	-0.1	0.0	0.0	0.0	0.1	0.1	0.0	-0.3	-0.5	-0.1	0.5

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-13-4. American River at Watt Avenue, Monthly Temperature

Second Basis of Comparison		Monthly Temperature (DEG-F)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	67	58	53	49	50	56	62	68	71	73	73	71	
20%	66	58	52	48	49	55	60	66	70	69	72	71	
30%	65	58	51	48	49	53	59	65	68	69	70	69	
40%	65	57	50	47	48	52	58	64	67	68	69	69	
50%	64	57	50	47	48	51	57	62	66	68	69	68	
60%	64	57	49	46	47	50	56	61	65	67	68	68	
70%	63	56	49	46	47	50	55	60	64	67	67	67	
80%	63	56	48	45	46	50	54	59	63	67	66	67	
90%	61	56	47	45	46	49	53	57	62	67	65	66	
Long Term													
Full Simulation Period ^b	64	57	50	47	48	52	57	63	66	69	69	68	
Water Year Types^c													
Wet (32%)	61	55	47	46	47	50	55	59	63	67	66	67	
Above Normal (16%)	64	57	50	47	47	50	56	62	66	67	68	68	
Below Normal (13%)	63	56	51	47	48	52	59	64	66	68	69	69	
Dry (24%)	65	57	50	47	49	53	59	64	68	69	70	69	
Critical (15%)	66	58	50	47	51	56	61	66	71	74	72	71	

No Action Alternative		Monthly Temperature (DEG-F)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	67	58	53	48	50	56	63	68	73	73	73	71	
20%	66	58	52	48	50	55	60	67	70	70	72	70	
30%	65	58	51	47	49	53	59	65	69	69	70	69	
40%	64	57	51	47	48	52	58	64	67	68	69	68	
50%	64	57	50	47	48	51	57	62	66	68	69	68	
60%	64	57	49	46	47	50	56	61	65	68	68	67	
70%	63	56	49	46	47	50	55	60	64	67	68	66	
80%	63	56	48	45	46	50	54	59	63	67	67	66	
90%	61	56	47	45	46	49	53	57	62	67	66	65	
Long Term													
Full Simulation Period ^b	64	57	50	47	48	52	57	63	66	69	69	68	
Water Year Types^c													
Wet (32%)	61	55	47	46	47	50	55	59	63	67	67	66	
Above Normal (16%)	65	57	50	47	47	50	56	62	66	67	68	67	
Below Normal (13%)	63	56	50	47	48	52	59	64	68	68	70	69	
Dry (24%)	64	57	50	47	49	53	58	64	68	69	70	69	
Critical (15%)	66	58	50	47	51	56	61	67	70	74	72	71	

No Action Alternative minus Second Basis of Comparison		Monthly Temperature (DEG-F)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
0.1	0.2	0.0	-0.2	-0.4	-0.1	0.1	0.2	-0.3	1.9	-0.1	0.4	-0.1	
0.2	0.2	0.1	0.0	-0.1	0.0	0.1	0.2	0.3	0.9	0.6	0.2	-0.3	
0.3	0.0	0.0	-0.3	-0.3	0.0	-0.1	0.1	0.0	0.3	0.2	0.2	-0.1	
0.4	-0.1	0.0	0.1	-0.2	0.0	0.0	0.0	0.0	0.2	0.1	0.2	-0.4	
0.5	-0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.2	0.1	-0.2	
0.6	0.1	0.0	-0.2	0.0	-0.1	0.0	0.0	-0.1	0.1	0.2	0.3	-0.4	
0.7	-0.1	0.0	-0.3	-0.2	0.0	0.0	0.0	0.0	0.0	0.3	0.3	-0.8	
0.8	0.1	0.1	-0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.4	-0.8	
0.9	0.2	0.0	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.2	-1.4	
Long Term													
Full Simulation Period ^b	0.0	0.0	-0.2	-0.1	0.0	0.0	0.1	0.0	0.2	0.2	0.2	-0.5	
Water Year Types^c													
Wet (32%)	0.1	0.1	-0.2	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.5	-1.1	
Above Normal (16%)	0.2	0.3	-0.1	-0.2	0.0	0.0	0.0	0.0	0.1	0.2	-0.1	-0.5	
Below Normal (13%)	-0.1	-0.1	-0.3	-0.3	0.0	0.0	0.3	-0.1	1.6	0.3	0.6	-0.2	
Dry (24%)	-0.1	0.0	-0.1	-0.1	0.0	0.0	0.0	-0.1	0.2	0.3	-0.1	0.0	
Critical (15%)	-0.1	-0.2	-0.1	-0.1	0.0	0.0	0.2	0.2	-0.5	-0.1	0.1	-0.1	

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-13-5. American River at Watt Avenue, Monthly Temperature

Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	67	58	53	49	50	56	62	68	71	73	73	71
20%	66	58	52	48	49	55	60	66	70	69	72	71
30%	65	58	51	48	49	53	59	65	68	69	70	69
40%	65	57	50	47	48	52	58	64	67	68	69	69
50%	64	57	50	47	48	51	57	62	66	68	69	68
60%	64	57	49	46	47	50	56	61	65	67	68	68
70%	63	56	49	46	47	50	55	60	64	67	67	67
80%	63	56	48	45	46	50	54	59	63	67	66	67
90%	61	56	47	45	46	49	53	57	62	67	65	66
Long Term												
Full Simulation Period ^b	64	57	50	47	48	52	57	63	66	69	69	68
Water Year Types ^c												
Wet (32%)	61	55	47	46	47	50	55	59	63	67	66	67
Above Normal (16%)	64	57	50	47	47	50	56	62	66	67	68	68
Below Normal (13%)	63	56	51	47	48	52	59	64	66	68	69	69
Dry (24%)	65	57	50	47	49	53	59	64	68	69	70	69
Critical (15%)	66	58	50	47	51	56	61	66	71	74	72	71

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	67	58	53	49	50	56	63	68	72	73	73	71
20%	66	58	52	48	50	55	60	66	69	70	72	70
30%	65	58	51	48	49	53	59	65	68	69	70	69
40%	64	57	50	47	48	52	58	64	67	68	69	69
50%	64	57	50	47	48	51	57	62	66	68	68	68
60%	64	57	49	46	47	50	56	61	64	68	68	68
70%	63	57	49	46	47	50	55	60	64	67	67	67
80%	63	56	48	45	46	50	54	59	63	67	66	67
90%	61	56	47	45	46	49	53	57	62	66	66	66
Long Term												
Full Simulation Period ^b	64	57	50	47	48	52	57	63	66	69	69	68
Water Year Types ^c												
Wet (32%)	61	54	48	46	47	50	55	59	63	67	66	67
Above Normal (16%)	65	57	50	47	47	50	56	62	66	67	68	68
Below Normal (13%)	63	57	51	47	48	52	59	64	67	68	69	69
Dry (24%)	65	57	50	47	49	53	59	64	68	69	70	69
Critical (15%)	66	58	50	47	51	55	61	66	71	74	73	71

Alternative 3 minus Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.0	0.0	-0.1	0.0	0.0	0.1	0.4	0.0	1.5	-0.2	0.6	0.0
0.2	0.2	0.0	0.0	0.1	0.0	0.0	0.2	0.1	-0.3	0.7	-0.1	-0.3
0.3	0.1	0.0	0.1	0.0	0.0	0.0	0.2	0.2	-0.1	0.0	0.3	-0.1
0.4	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3	0.1	0.0	-0.2
0.5	-0.1	0.0	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.3	0.0	0.0
0.6	0.0	-0.1	0.0	0.1	0.0	0.0	0.0	0.0	-0.2	0.2	0.2	0.0
0.7	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.1	0.1
0.8	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.2	0.0
0.9	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	-0.2	0.1	-0.5	
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.1	-0.1
Above Normal (16%)	0.2	0.2	-0.1	-0.1	0.0	0.0	0.0	0.0	-0.1	0.0	0.2	0.1
Below Normal (13%)	0.0	0.2	0.0	0.0	0.0	0.0	0.2	0.1	1.0	0.1	0.0	-0.1
Dry (24%)	-0.1	0.0	0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.3	-0.2	-0.1
Critical (15%)	-0.1	-0.1	-0.1	0.0	0.0	-0.1	0.1	0.0	-0.2	-0.1	0.2	0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-13-6. American River at Watt Avenue, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	67	58	53	49	50	56	62	68	71	73	73	71
20%	66	58	52	48	49	55	60	66	70	69	72	71
30%	65	58	51	48	49	53	59	65	68	69	70	69
40%	65	57	50	47	48	52	58	64	67	68	69	69
50%	64	57	50	47	48	51	57	62	66	68	69	68
60%	64	57	49	46	47	50	56	61	65	67	68	68
70%	63	56	49	46	47	50	55	60	64	67	67	67
80%	63	56	48	45	46	50	54	59	63	67	66	67
90%	61	56	47	45	46	49	53	57	62	67	65	66
Long Term												
Full Simulation Period ^b	64	57	50	47	48	52	57	63	66	69	69	68
Water Year Types ^c												
Wet (32%)	61	55	47	46	47	50	55	59	63	67	66	67
Above Normal (16%)	64	57	50	47	47	50	56	62	66	67	68	68
Below Normal (13%)	63	56	51	47	48	52	59	64	66	68	69	69
Dry (24%)	65	57	50	47	49	53	59	64	68	69	70	69
Critical (15%)	66	58	50	47	51	56	61	66	71	74	72	71

Alternative 5

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	67	58	53	48	50	56	63	68	73	73	73	71
20%	66	58	52	48	50	55	60	67	70	70	72	70
30%	65	58	51	47	49	53	59	65	68	69	70	69
40%	64	57	51	47	48	52	58	64	67	68	69	68
50%	64	57	50	47	48	51	57	62	66	68	69	68
60%	64	57	49	46	47	50	56	61	65	67	68	67
70%	63	56	48	46	47	50	55	60	64	67	68	66
80%	63	56	48	45	46	50	54	59	63	67	67	66
90%	61	56	47	45	46	49	53	57	62	66	66	65
Long Term												
Full Simulation Period ^b	64	57	50	47	48	52	57	63	66	69	69	68
Water Year Types ^c												
Wet (32%)	61	55	47	46	47	50	55	59	63	67	67	66
Above Normal (16%)	65	57	50	47	47	50	56	62	66	67	68	67
Below Normal (13%)	63	56	50	47	48	52	59	64	68	68	70	69
Dry (24%)	64	57	50	47	49	53	58	64	68	69	70	69
Critical (15%)	66	58	50	47	51	56	61	67	70	74	72	72

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.2	0.0	-0.2	-0.4	-0.1	0.2	0.3	0.2	2.1	-0.2	0.5	0.0
0.2	0.3	0.0	0.1	-0.1	0.0	0.1	0.3	0.6	0.6	0.3	0.0	-0.1
0.3	0.1	-0.1	-0.3	-0.3	0.0	-0.1	0.1	0.0	0.0	0.0	0.1	-0.2
0.4	-0.2	0.0	0.1	-0.2	-0.1	0.0	0.0	0.0	0.3	0.0	0.2	-0.6
0.5	-0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.0	-0.2
0.6	-0.1	0.0	-0.1	0.0	-0.1	-0.1	0.0	0.0	0.1	0.2	0.1	-0.4
0.7	-0.1	0.0	-0.3	-0.2	0.0	0.0	0.0	0.0	0.0	0.2	0.2	-0.8
0.8	0.1	0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.8	-0.8
0.9	0.4	-0.1	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	-0.2	0.4	-1.3
Long Term												
Full Simulation Period ^b	0.0	0.0	-0.2	-0.1	0.0	0.0	0.1	0.0	0.2	0.0	0.3	-0.4
Water Year Types ^c												
Wet (32%)	0.0	0.0	-0.2	-0.1	0.0	0.0	0.0	0.0	0.0	-0.1	0.6	-1.1
Above Normal (16%)	0.2	0.1	-0.1	-0.2	0.0	0.0	0.0	0.0	0.2	0.2	-0.1	-0.5
Below Normal (13%)	-0.1	-0.1	-0.4	-0.3	-0.1	0.0	0.3	0.0	1.6	0.2	0.7	-0.1
Dry (24%)	-0.1	0.0	0.0	-0.1	0.0	0.0	0.0	0.1	0.3	0.1	-0.1	0.0
Critical (15%)	-0.1	-0.2	-0.2	-0.1	0.0	0.1	0.3	0.2	-0.7	-0.6	0.1	0.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


B.14. American River at Mouth Temperature

Figure B-14-1. American River at the Mouth, October

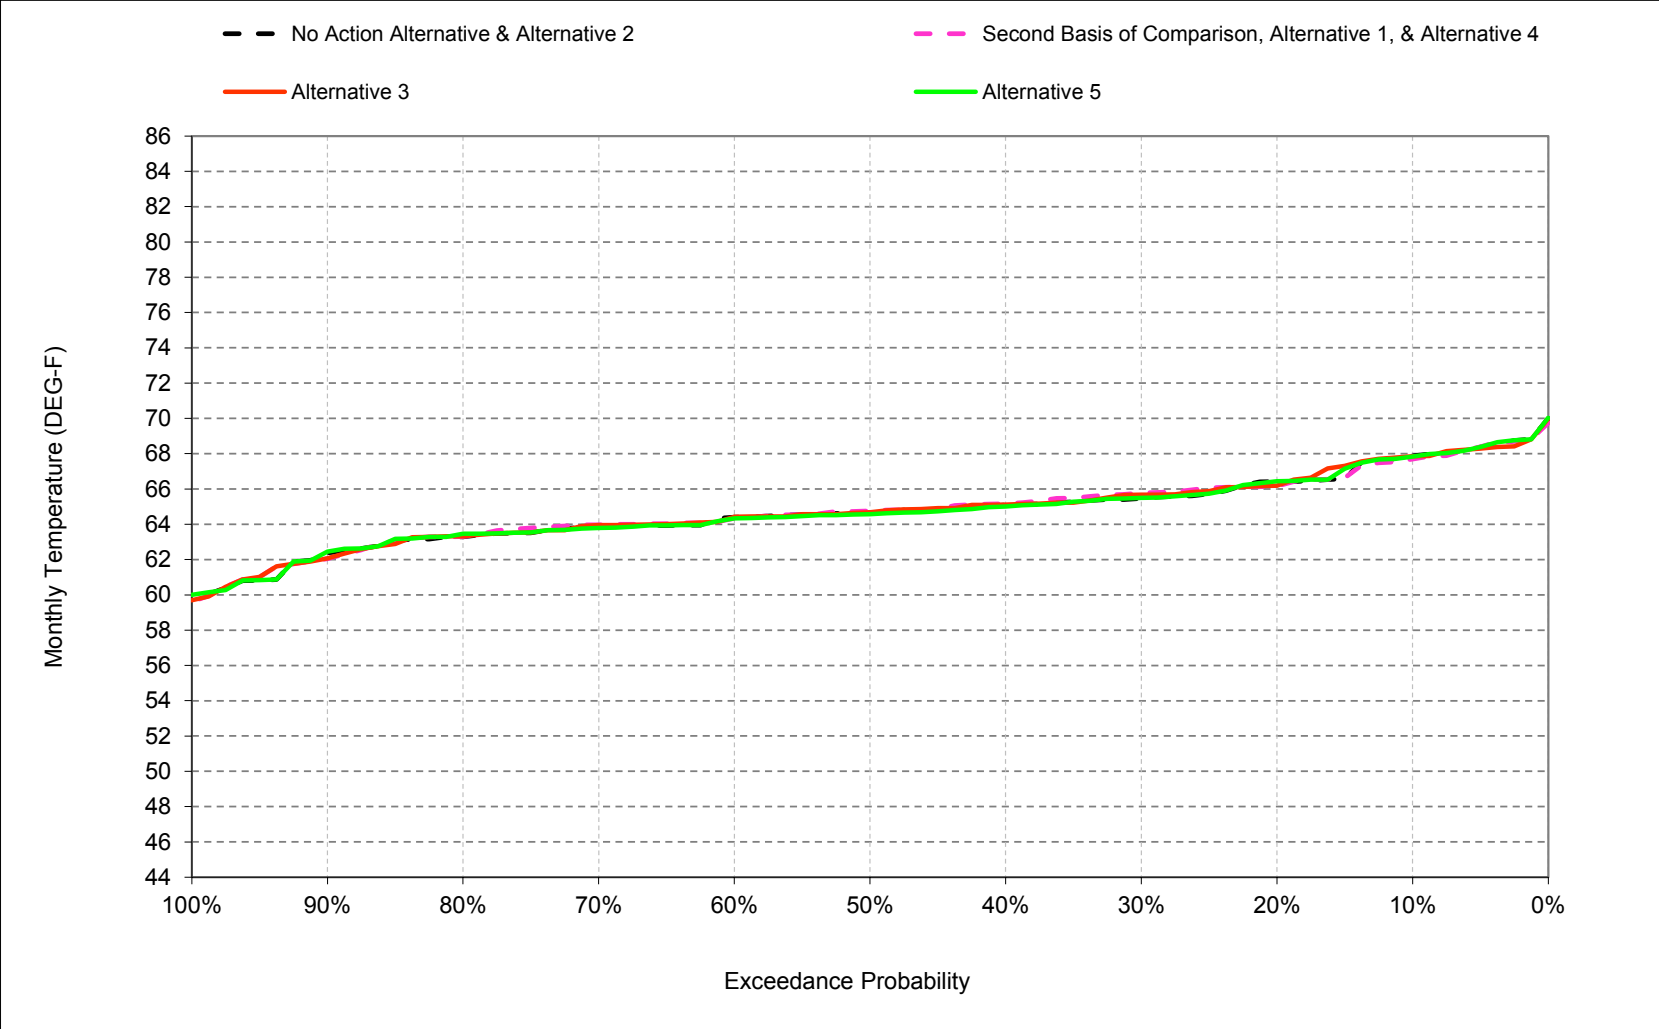


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-14-2. American River at the Mouth, November

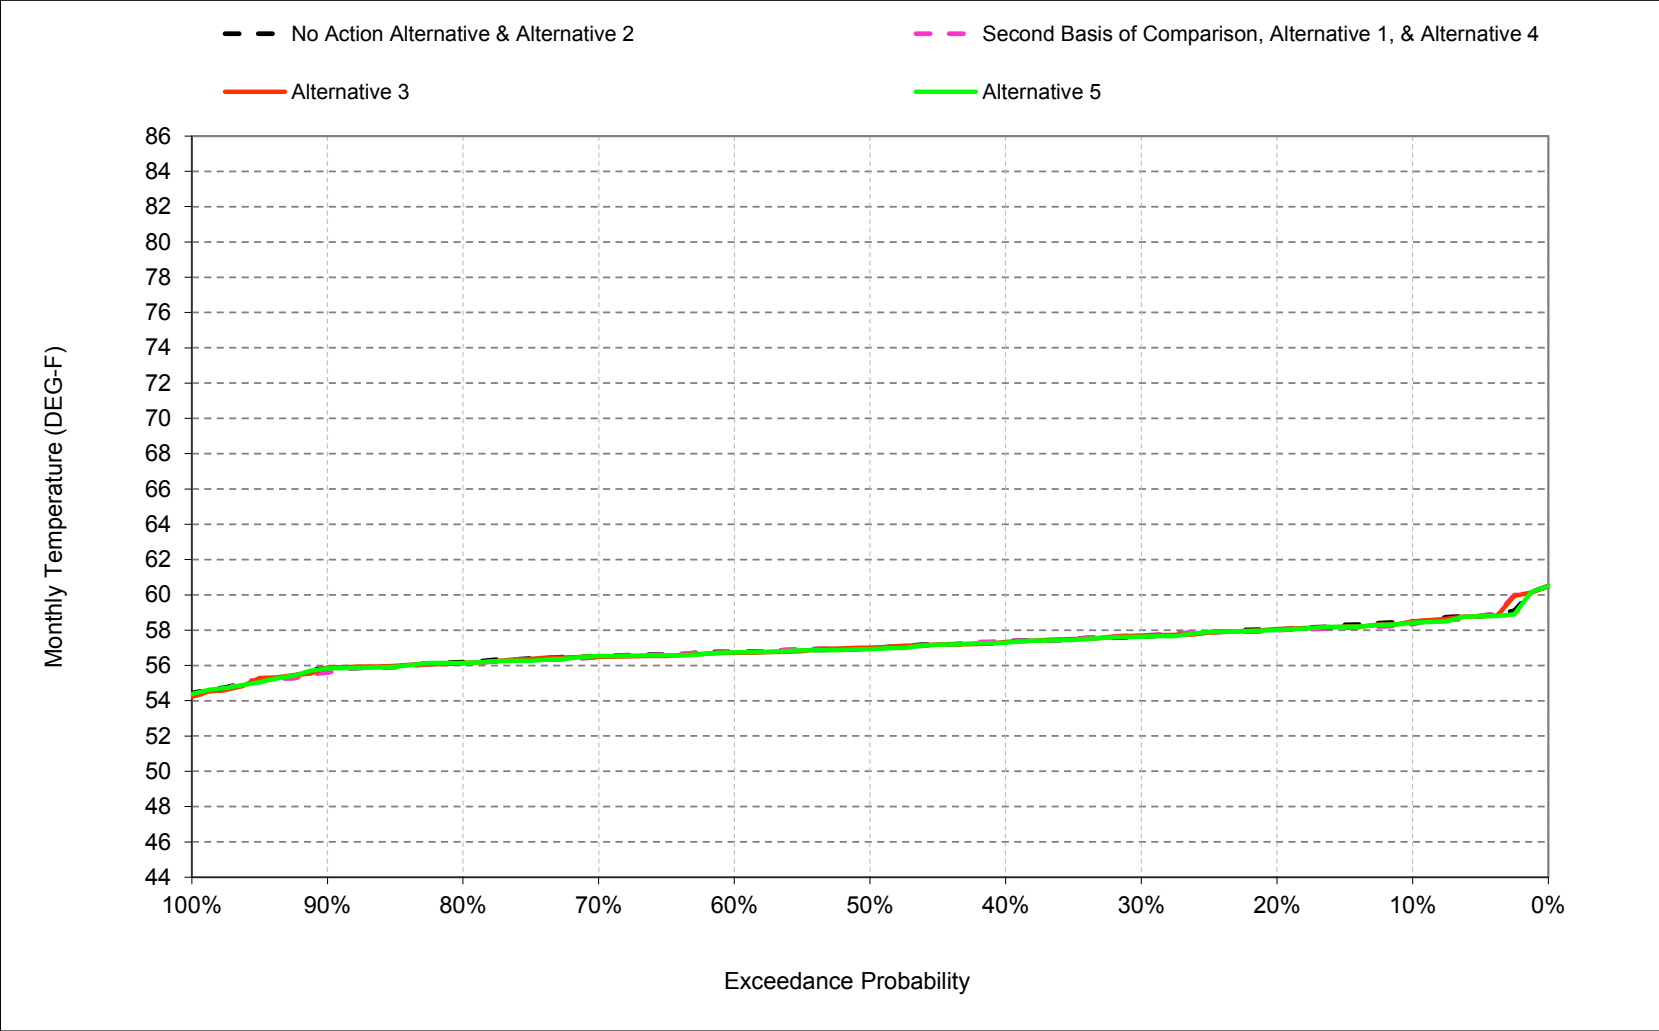


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-14-3. American River at the Mouth, December

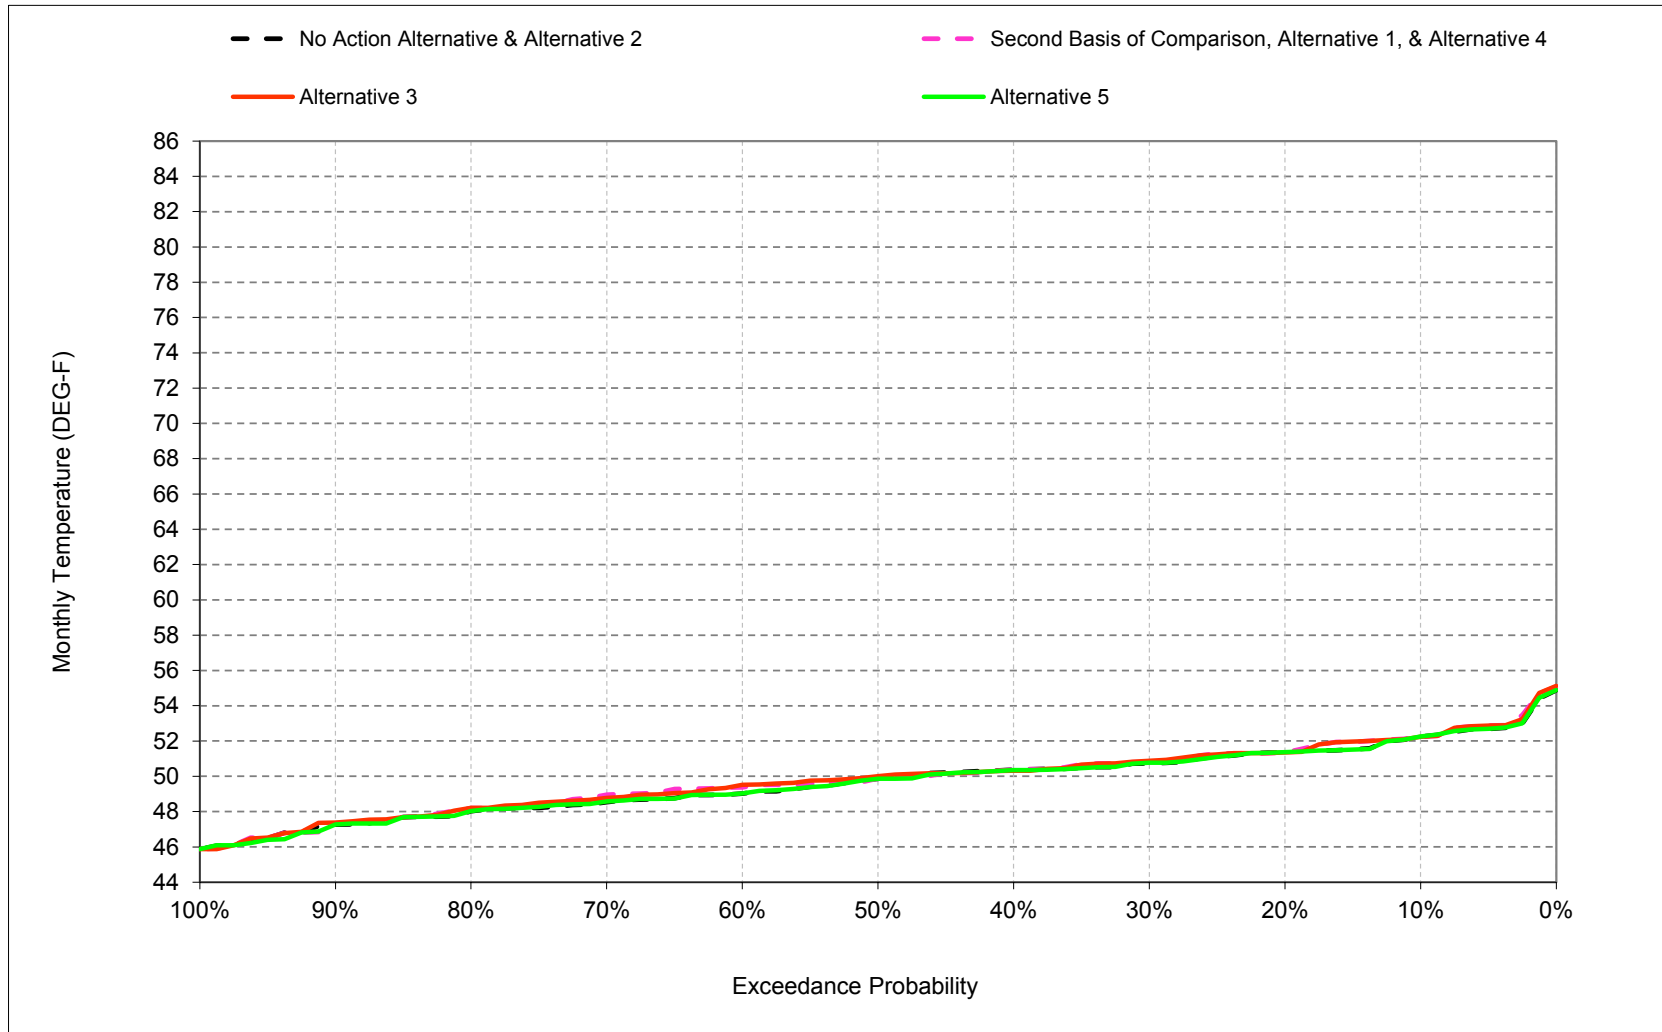


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-14-4. American River at the Mouth, January

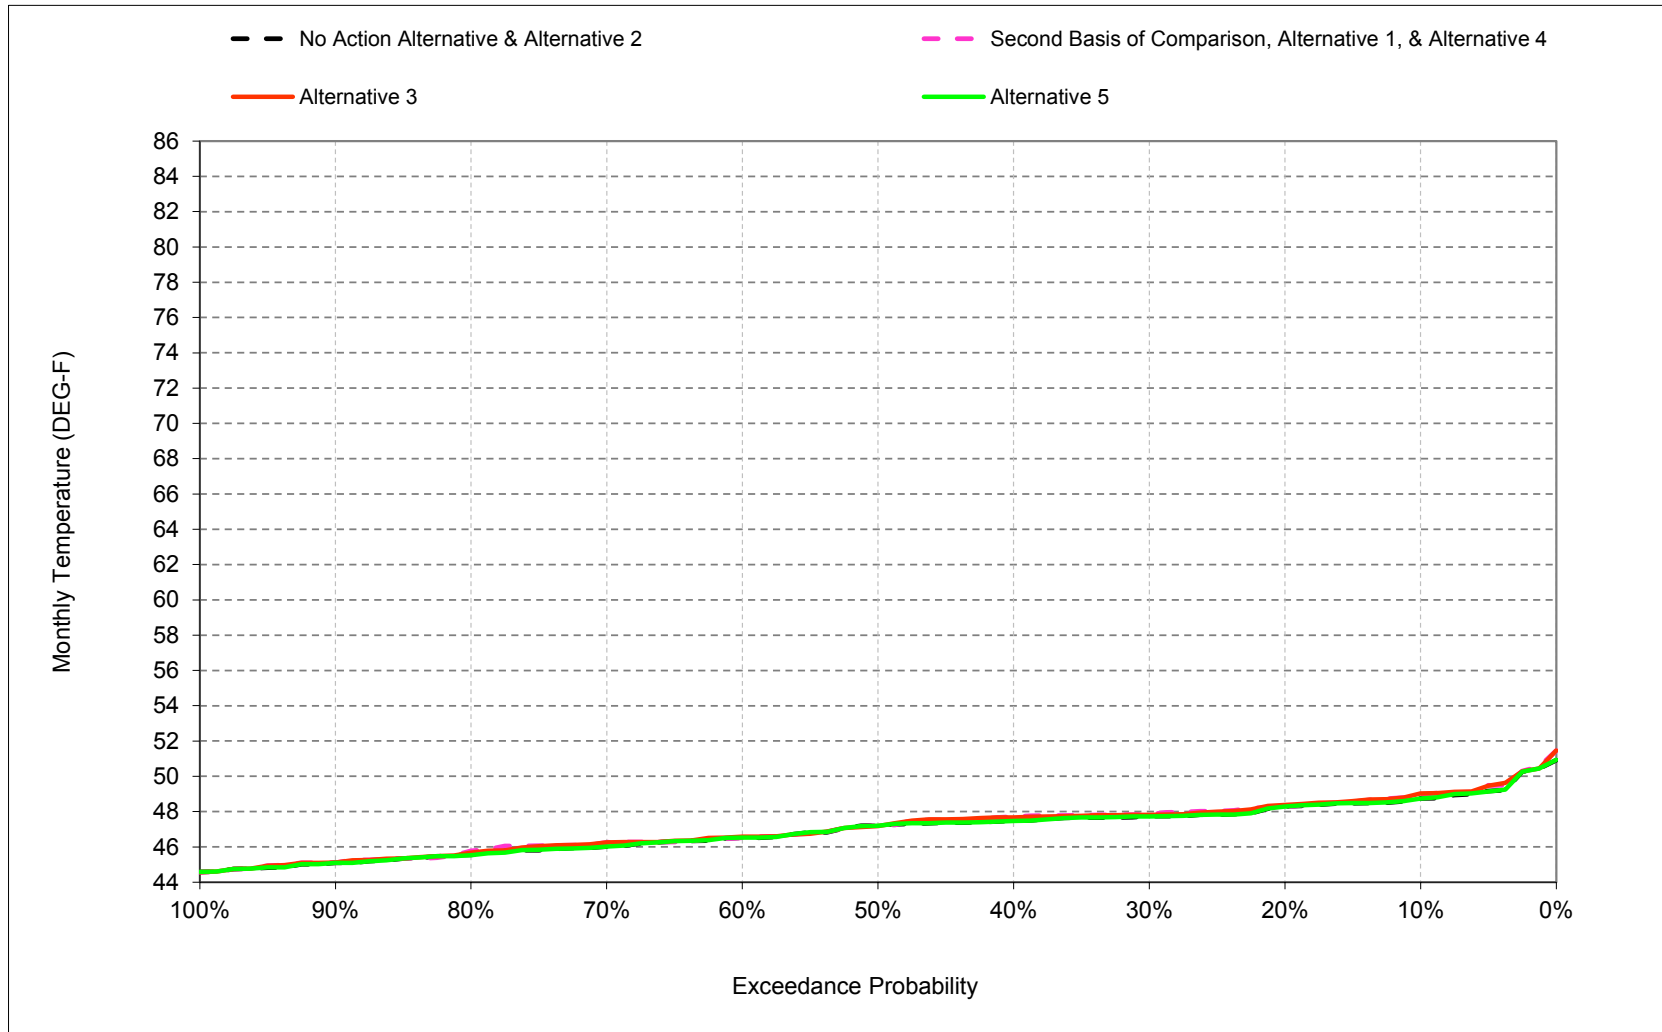


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-14-5. American River at the Mouth, February

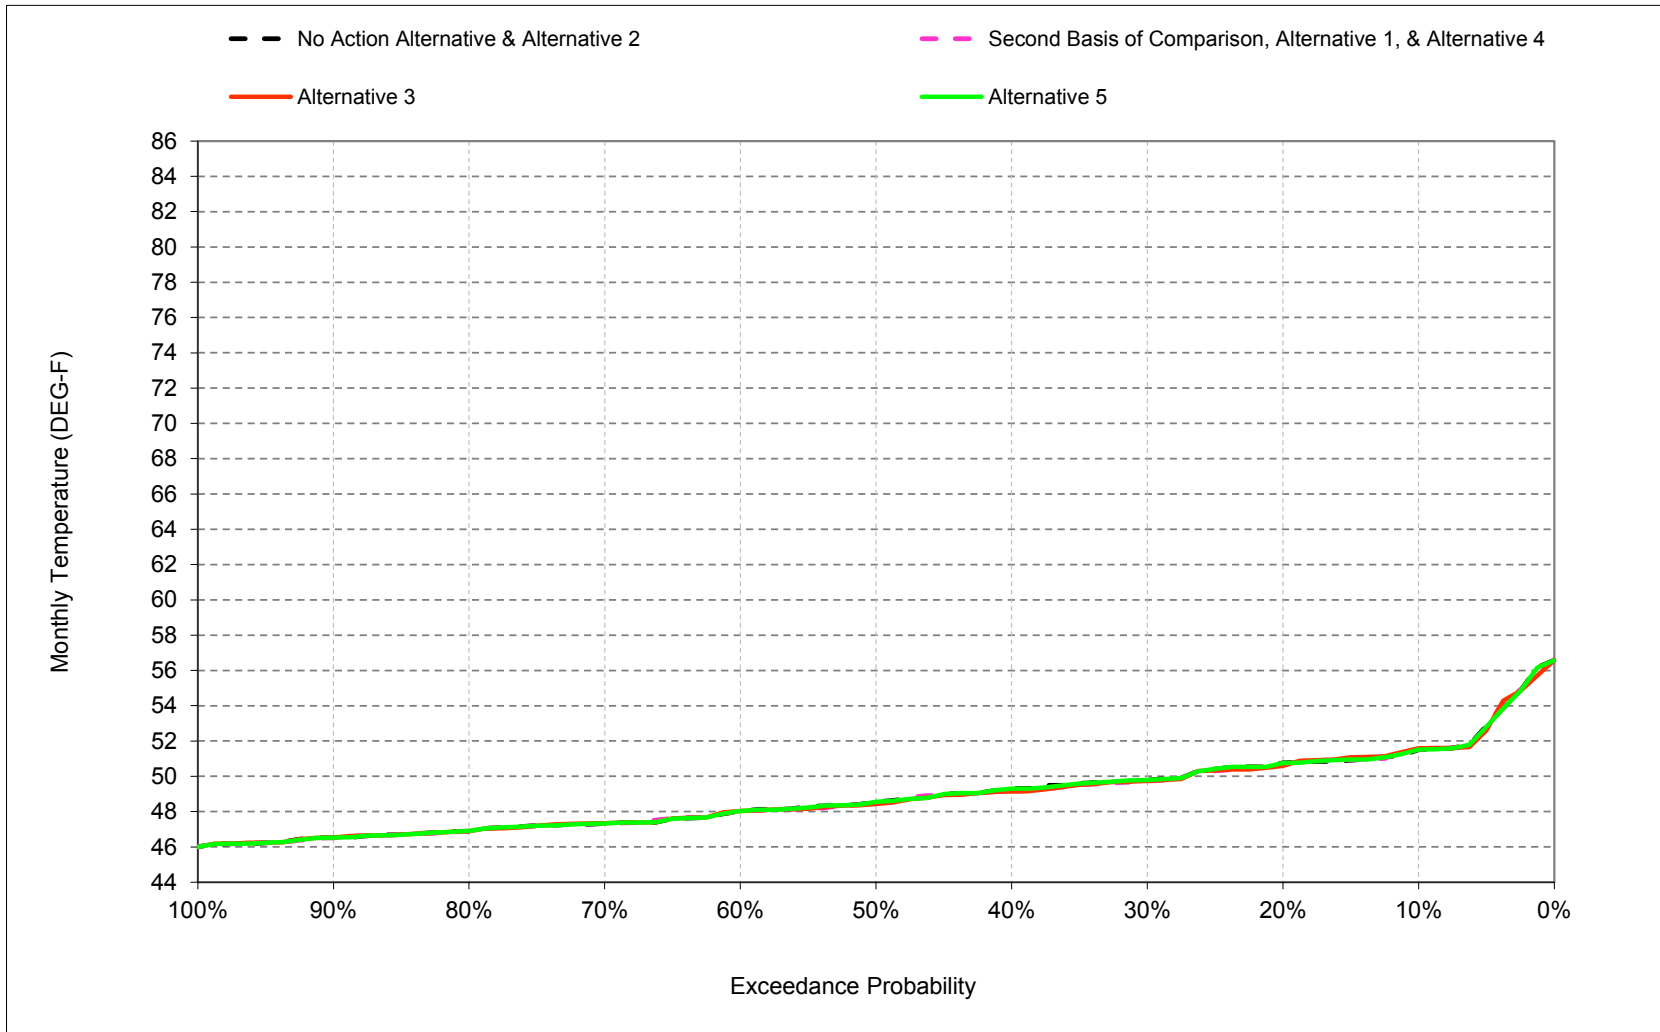


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-14-6. American River at the Mouth, March

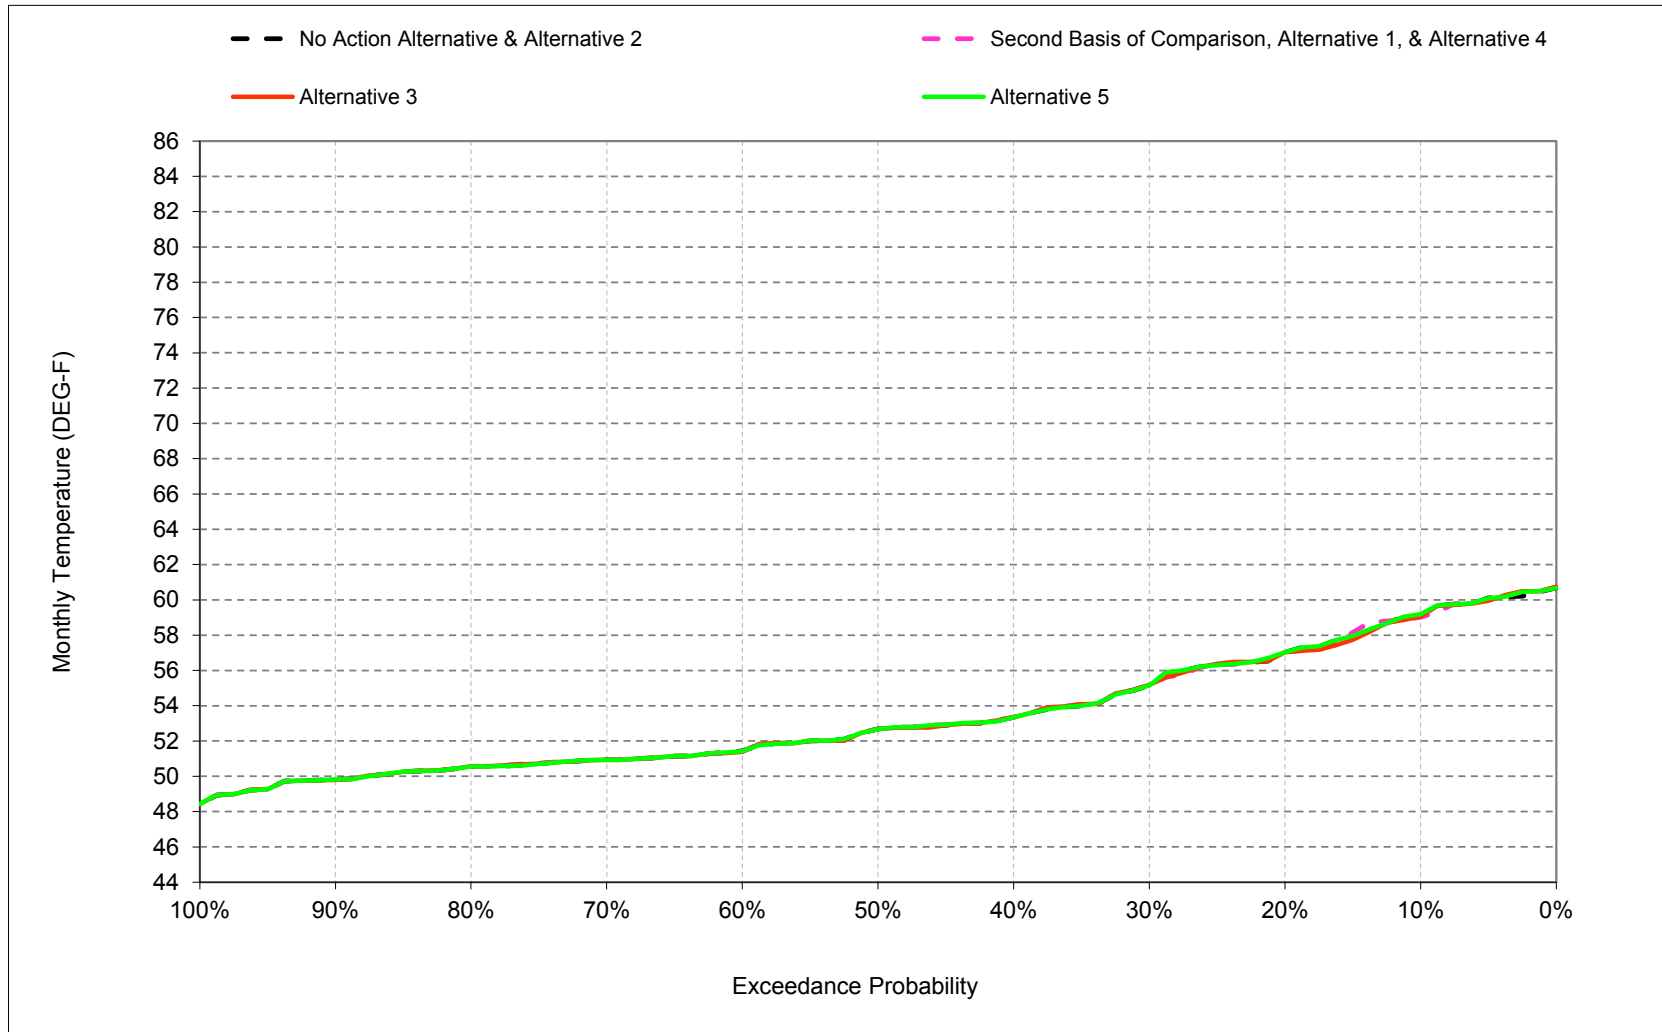


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-14-7. American River at the Mouth, April

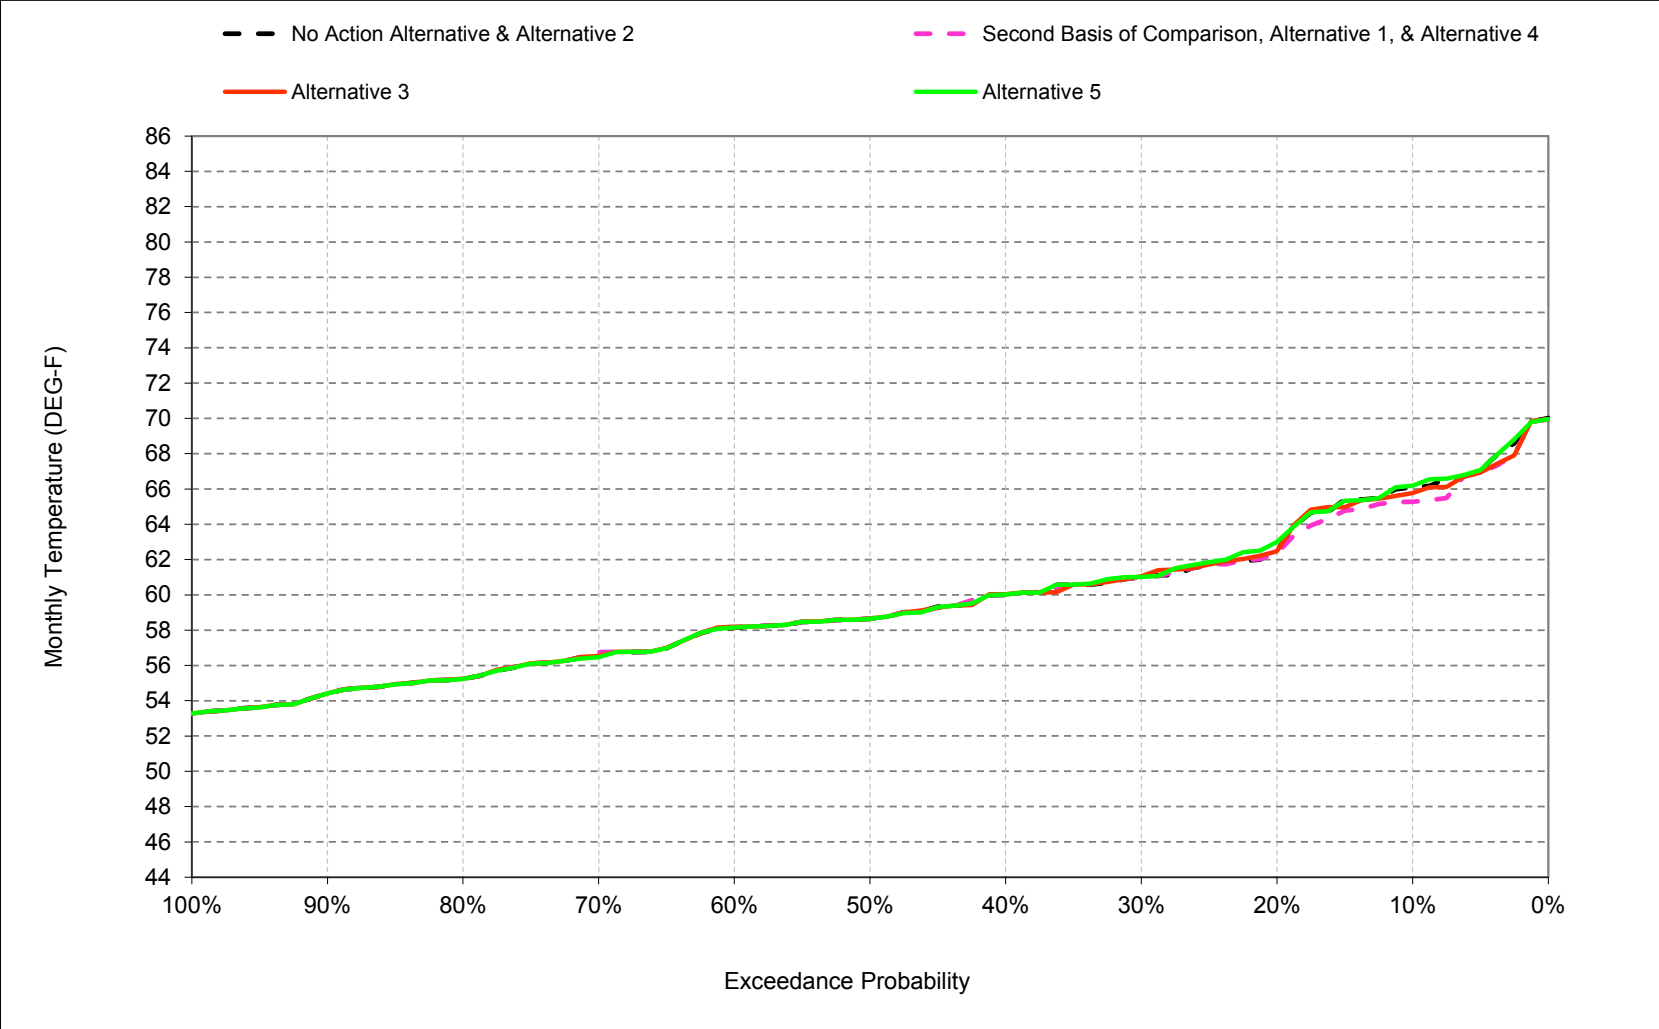


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-14-8. American River at the Mouth, May

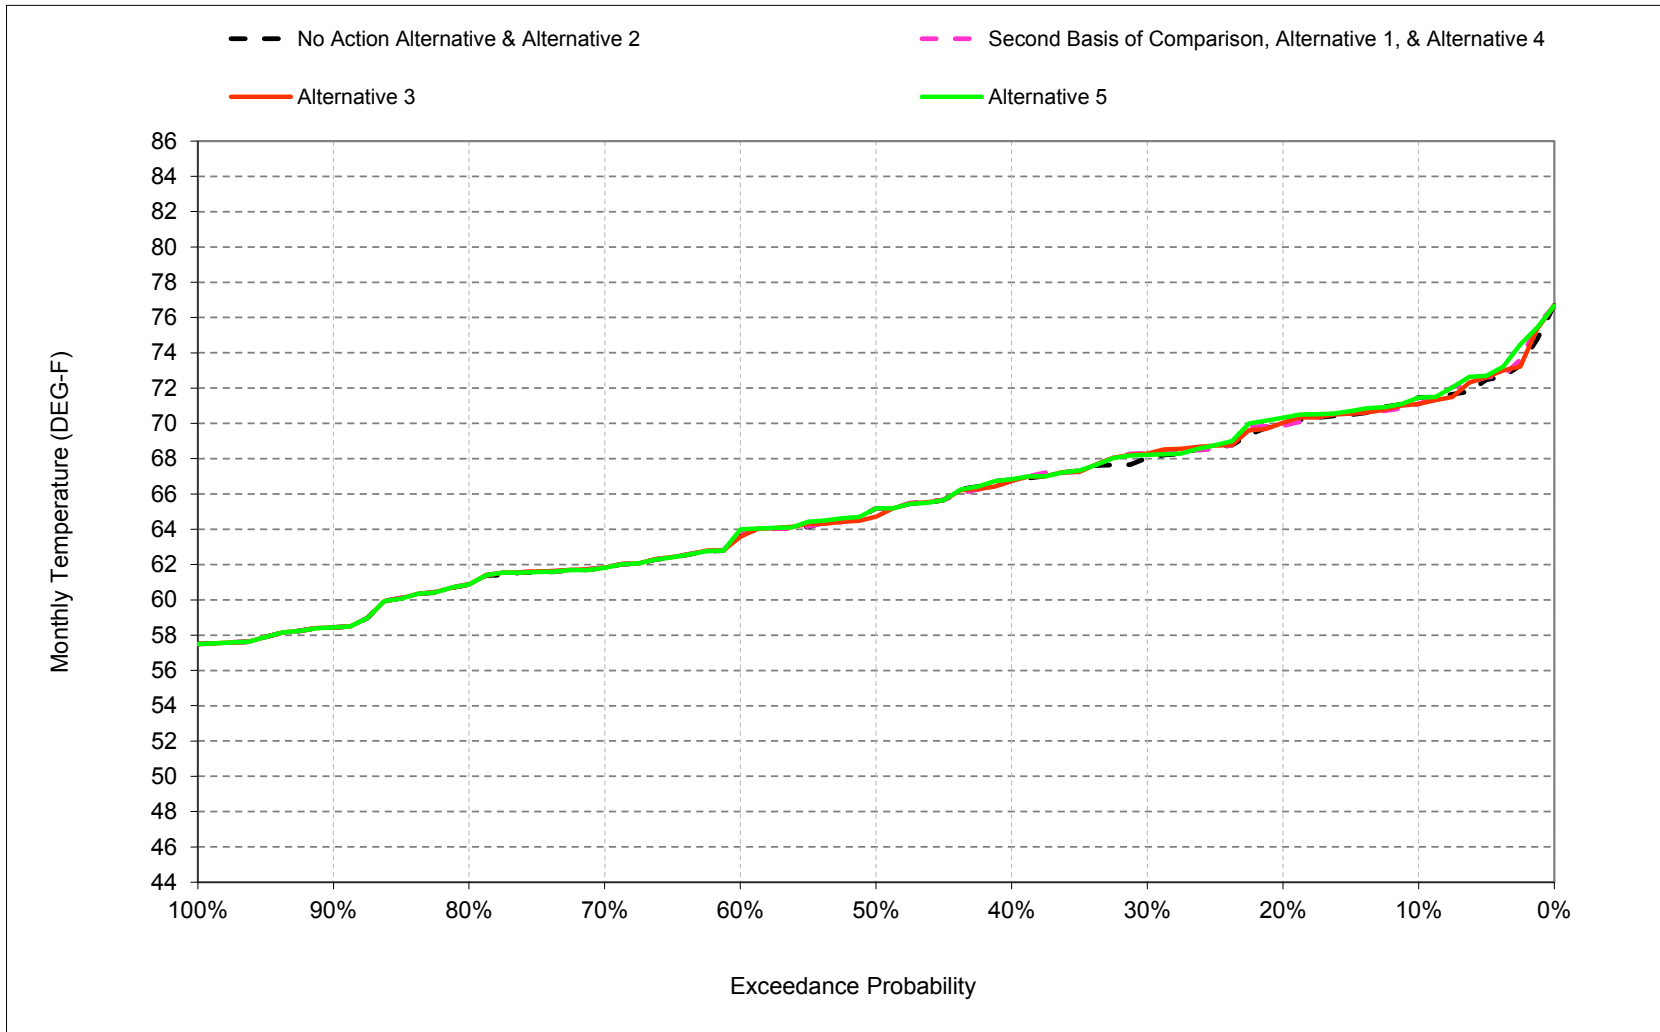


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-14-9. American River at the Mouth, June

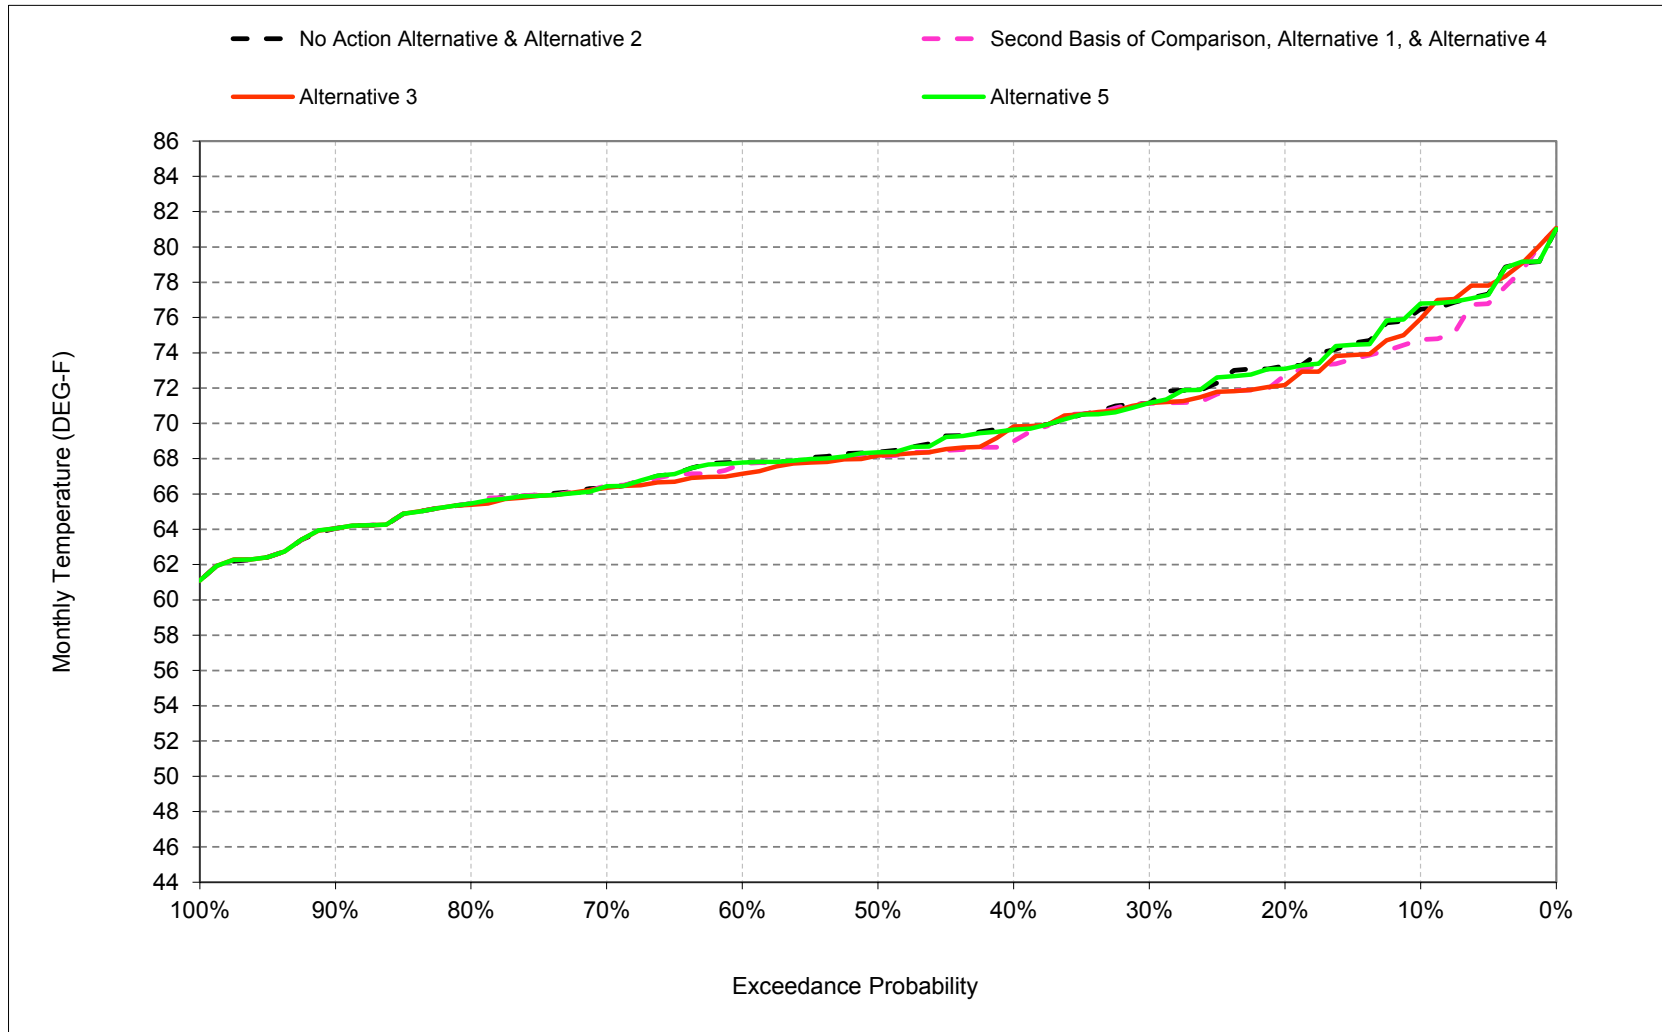


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-14-10. American River at the Mouth, July

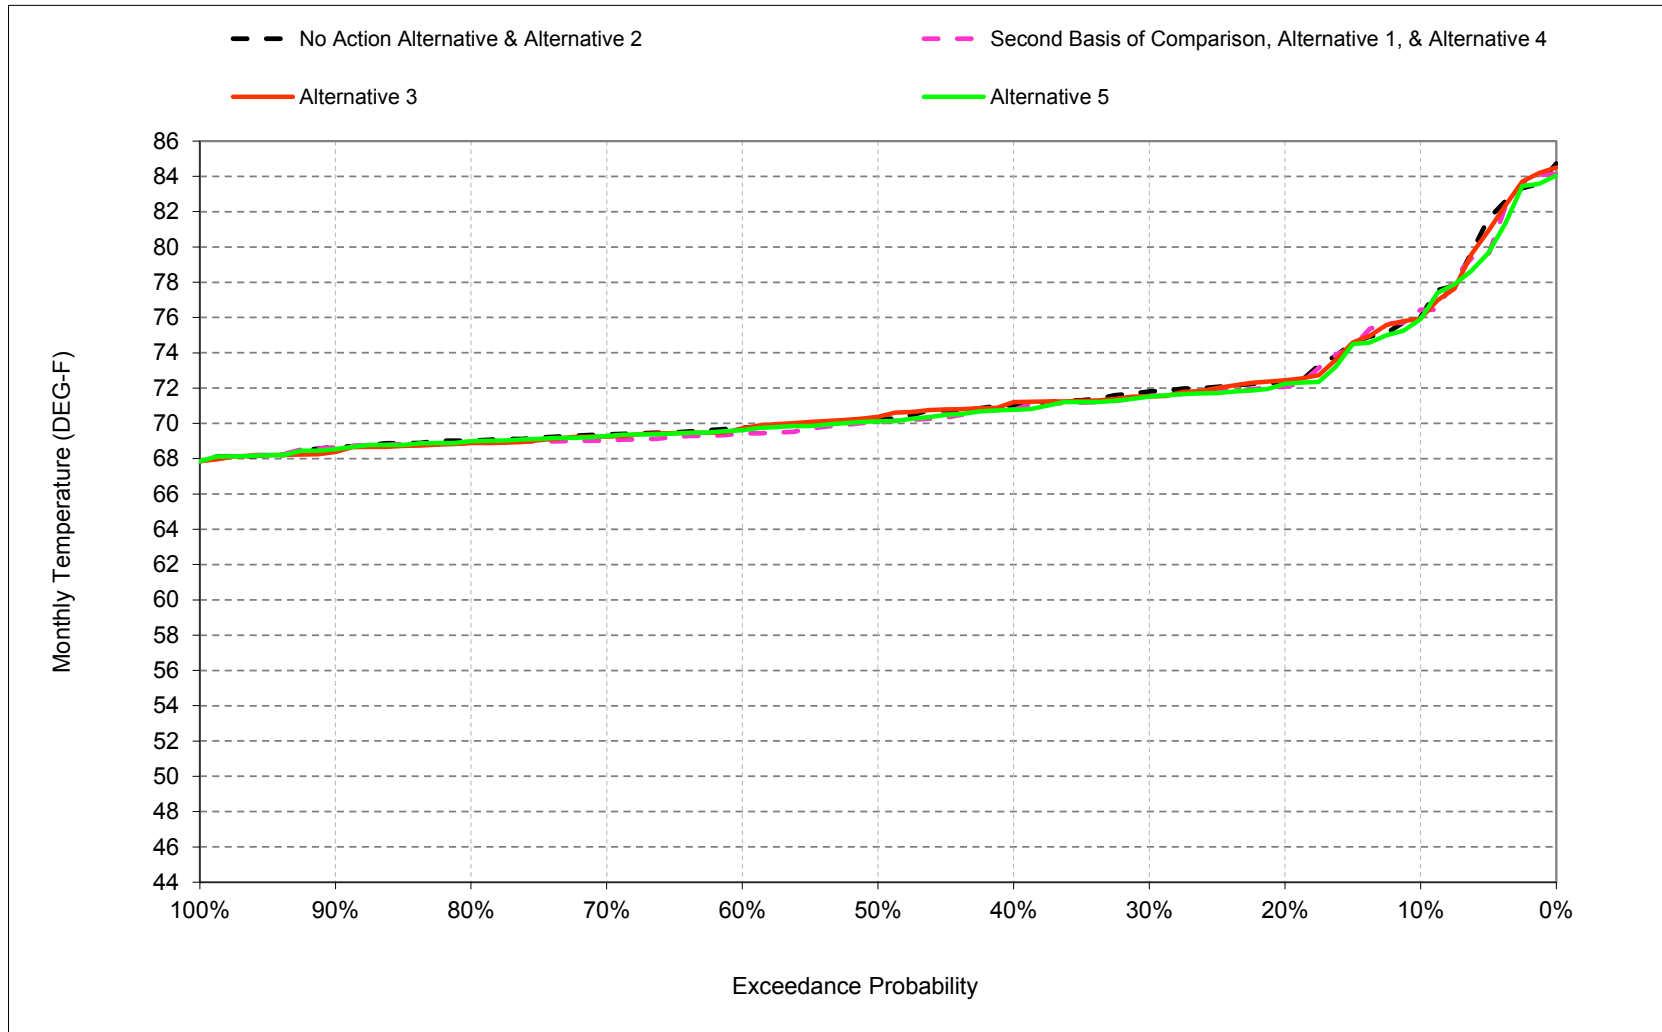


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-14-11. American River at the Mouth, August

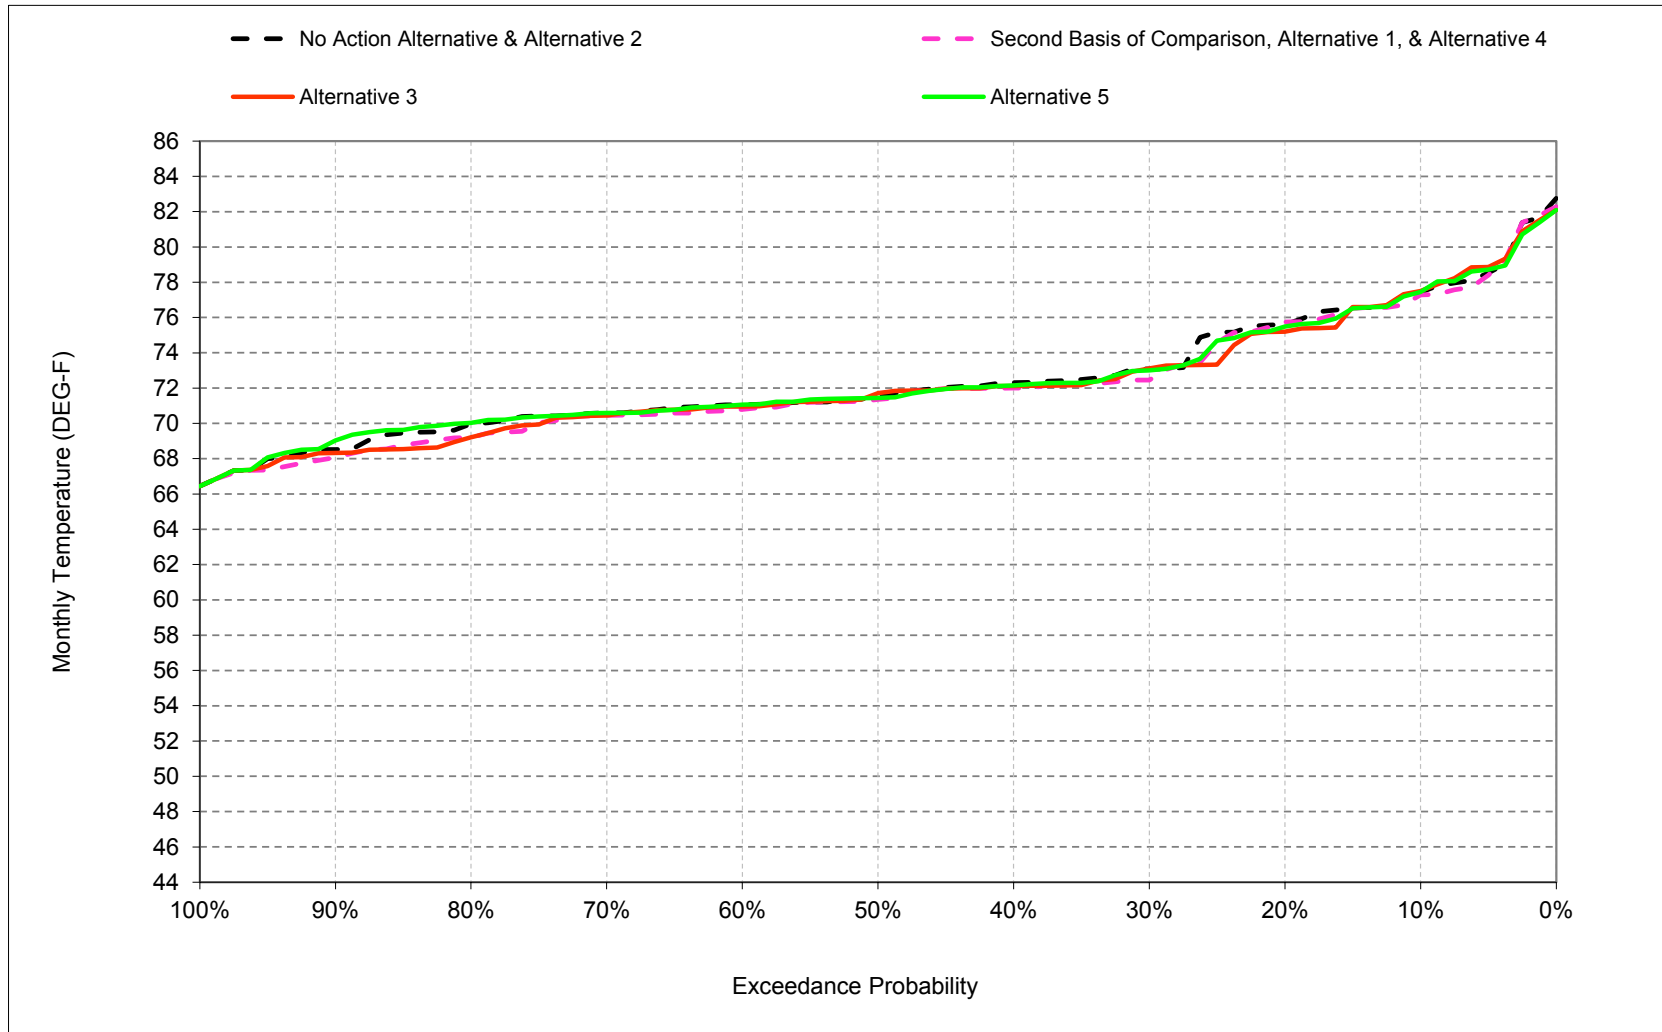

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-14-12. American River at the Mouth, September

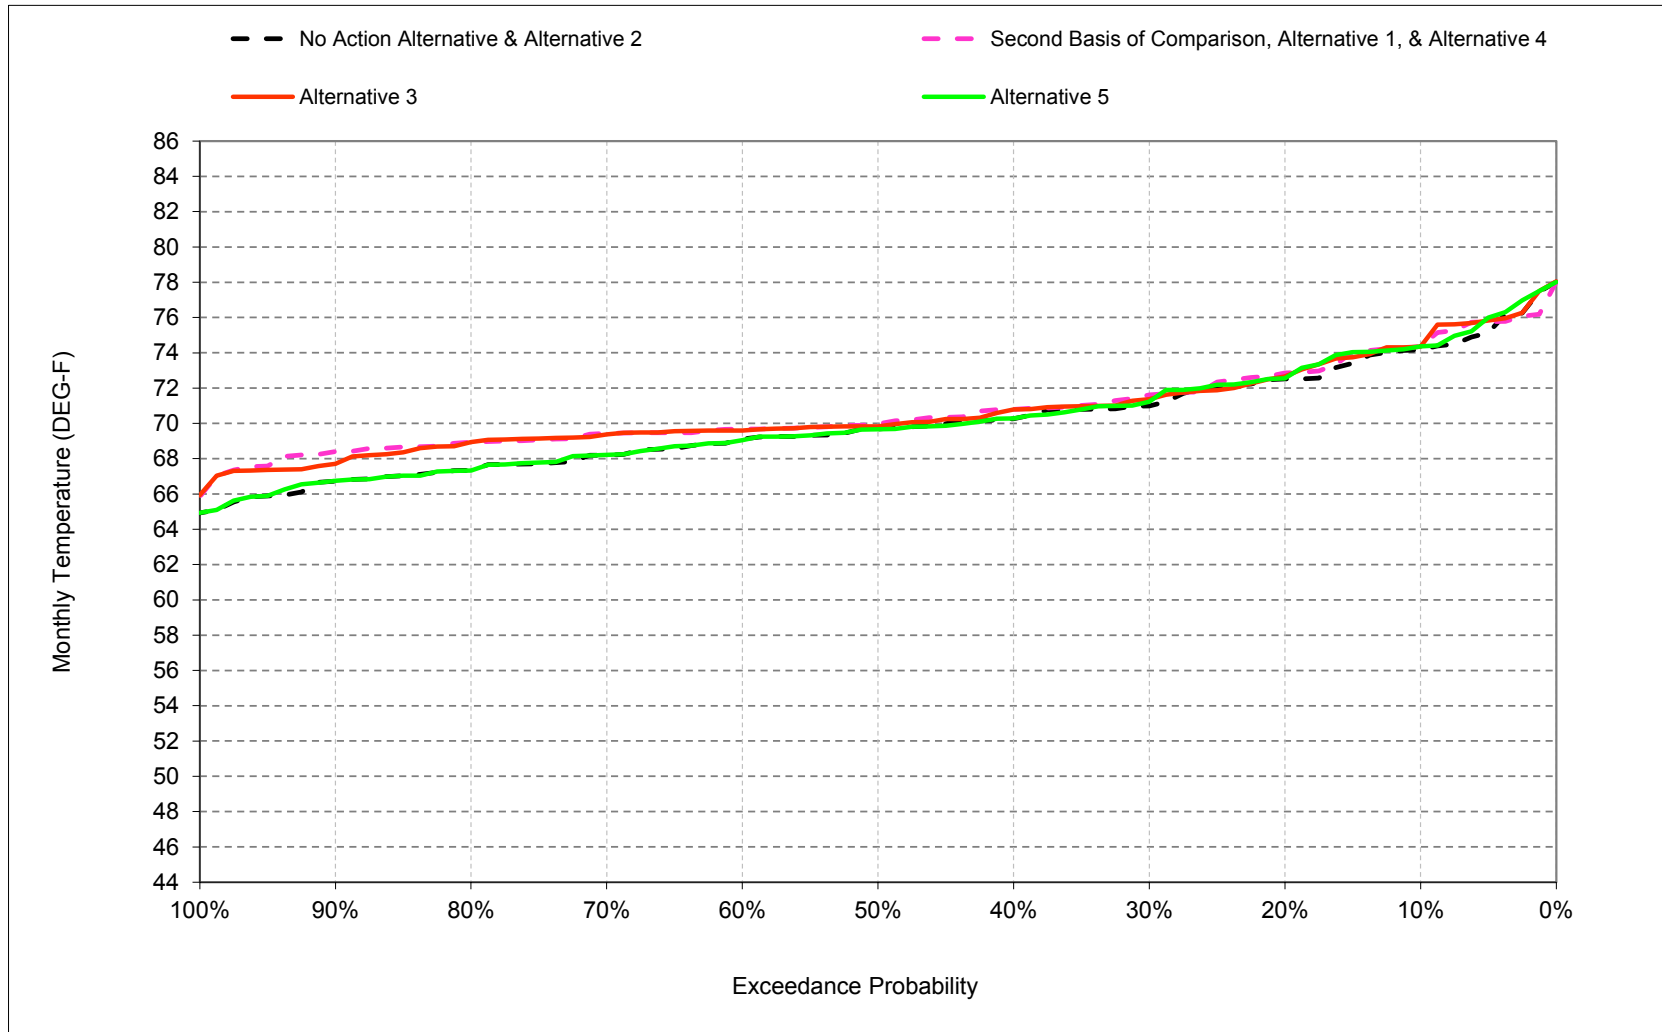

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-14-1. American River at the Mouth, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	68	58	52	49	51	59	66	71	76	76	77	74
20%	66	58	51	48	51	57	62	70	73	72	76	73
30%	65	58	51	48	50	55	61	68	71	72	73	71
40%	65	57	50	47	49	53	60	67	70	71	72	70
50%	65	57	50	47	48	53	59	65	68	70	71	70
60%	64	57	49	47	48	51	58	63	68	70	71	69
70%	64	57	49	46	47	51	57	62	66	69	71	68
80%	63	56	48	46	47	50	55	61	65	69	70	67
90%	62	56	47	45	47	50	54	58	64	69	69	67
Long Term												
Full Simulation Period ^b	65	57	50	47	49	53	59	65	69	72	72	70
Water Year Types ^c												
Wet (32%)	61	55	47	46	47	51	56	61	66	70	70	67
Above Normal (16%)	65	57	50	47	48	51	58	65	69	69	71	69
Below Normal (13%)	64	56	50	47	49	54	61	67	71	70	73	71
Dry (24%)	65	57	50	47	50	55	61	67	71	72	74	72
Critical (15%)	66	58	50	48	52	58	64	69	73	78	76	74

Alternative 1												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	68	58	52	49	52	59	65	71	75	76	77	74
20%	66	58	51	48	51	57	62	70	73	72	76	73
30%	66	58	51	48	50	55	61	68	71	72	72	72
40%	65	57	50	48	49	53	60	67	69	71	72	71
50%	65	57	50	47	48	53	59	65	68	70	71	70
60%	64	57	49	46	48	51	58	63	67	69	71	70
70%	64	56	49	46	47	51	57	62	66	69	70	69
80%	63	56	48	46	47	50	55	61	65	69	69	69
90%	62	56	47	45	47	50	54	58	64	69	68	68
Long Term												
Full Simulation Period ^b	65	57	50	47	49	53	59	65	69	71	72	71
Water Year Types ^c												
Wet (32%)	61	55	47	46	47	51	56	61	66	70	69	69
Above Normal (16%)	65	57	50	47	48	51	58	65	68	69	71	70
Below Normal (13%)	64	56	50	48	49	54	61	67	69	70	73	71
Dry (24%)	65	57	50	48	50	55	61	67	70	72	74	72
Critical (15%)	66	58	50	48	52	58	64	69	74	78	76	74

Alternative 1 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.2	-0.2	0.0	0.2	0.0	-0.1	-0.8	-0.4	-1.7	0.4	-0.2	0.2
0.2	-0.3	0.0	0.0	0.0	-0.1	0.0	-0.1	-0.1	-0.7	-0.2	0.1	0.3
0.3	0.3	0.1	0.1	0.1	0.0	0.0	0.0	0.4	0.0	-0.3	-0.6	0.6
0.4	0.1	0.0	0.0	0.2	-0.1	0.0	0.0	-0.2	-0.8	-0.3	-0.3	0.5
0.5	0.1	0.1	0.0	0.0	-0.1	0.0	0.0	0.0	-0.2	-0.2	-0.1	0.2
0.6	-0.1	0.0	0.4	0.0	0.0	-0.1	0.1	0.1	-0.3	-0.3	-0.3	0.7
0.7	0.1	0.0	0.4	0.2	0.0	0.0	0.1	0.0	0.0	-0.3	-0.1	1.2
0.8	0.0	-0.1	0.2	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.5	1.6
0.9	-0.3	-0.2	0.1	0.1	0.0	0.0	0.0	0.0	0.1	0.0	-0.6	1.6
Long Term												
Full Simulation Period ^b	0.1	0.0	0.1	0.1	0.0	0.0	-0.1	0.0	-0.3	-0.2	-0.3	0.7
Water Year Types ^c												
Wet (32%)	0.0	-0.1	0.2	0.1	0.0	0.0	0.0	0.0	-0.1	-0.1	-0.6	1.7
Above Normal (16%)	-0.1	-0.2	0.1	0.2	-0.1	0.0	0.0	0.0	-0.5	-0.2	0.1	0.8
Below Normal (13%)	0.2	0.1	0.3	0.2	-0.1	0.0	-0.3	0.1	-2.0	-0.4	-0.5	0.1
Dry (24%)	0.2	0.0	0.0	0.1	0.0	0.0	0.0	0.1	-0.2	-0.4	0.1	0.0
Critical (15%)	0.0	0.2	0.1	0.1	0.0	0.0	-0.4	-0.1	0.6	0.1	-0.3	0.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-14-2. American River at the Mouth, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	68	58	52	49	51	59	66	71	76	76	77	74
20%	66	58	51	48	51	57	62	70	73	72	76	73
30%	65	58	51	48	50	55	61	68	71	72	73	71
40%	65	57	50	47	49	53	60	67	70	71	72	70
50%	65	57	50	47	48	53	59	65	68	70	71	70
60%	64	57	49	47	48	51	58	63	68	70	71	69
70%	64	57	49	46	47	51	57	62	66	69	71	68
80%	63	56	48	46	47	50	55	61	65	69	70	67
90%	62	56	47	45	47	50	54	58	64	69	69	67
Long Term												
Full Simulation Period ^b	65	57	50	47	49	53	59	65	69	72	72	70
Water Year Types ^c												
Wet (32%)	61	55	47	46	47	51	56	61	66	70	70	67
Above Normal (16%)	65	57	50	47	48	51	58	65	69	69	71	69
Below Normal (13%)	64	56	50	47	49	54	61	67	71	70	73	71
Dry (24%)	65	57	50	47	50	55	61	67	71	72	74	72
Critical (15%)	66	58	50	48	52	58	64	69	73	78	76	74

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	68	59	52	49	52	59	66	71	76	76	77	74
20%	66	58	51	48	51	57	62	70	72	72	75	73
30%	66	58	51	48	50	55	61	68	71	72	73	71
40%	65	57	50	48	49	53	60	67	70	71	72	71
50%	65	57	50	47	48	53	59	65	68	70	72	70
60%	64	57	50	47	48	51	58	63	67	70	71	70
70%	64	56	49	46	47	51	57	62	66	69	70	69
80%	63	56	48	46	47	50	55	61	65	69	69	69
90%	62	56	47	45	47	50	54	58	64	68	68	68
Long Term												
Full Simulation Period ^b	65	57	50	47	49	53	59	65	69	71	72	71
Water Year Types ^c												
Wet (32%)	61	55	47	46	47	51	56	61	65	70	69	69
Above Normal (16%)	65	57	50	47	48	51	58	65	68	69	71	70
Below Normal (13%)	64	57	50	48	49	54	61	67	70	70	73	71
Dry (24%)	65	57	50	48	50	55	61	67	71	72	73	72
Critical (15%)	66	58	50	48	52	58	64	69	74	78	76	74

Alternative 3 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.0	0.0	0.0	0.3	0.1	-0.1	-0.3	-0.3	-0.6	-0.1	0.1	0.2
0.2	-0.2	0.0	0.0	0.1	-0.2	0.0	0.0	0.0	-1.1	0.1	-0.4	0.1
0.3	0.2	0.1	0.2	0.1	0.0	0.0	0.0	0.3	0.0	-0.2	0.0	0.4
0.4	0.0	0.0	-0.1	0.2	-0.1	0.0	0.0	-0.2	-0.1	0.1	-0.2	0.5
0.5	0.0	0.0	0.1	-0.1	-0.1	0.0	0.0	-0.3	-0.3	0.1	0.1	0.2
0.6	0.0	-0.1	0.5	0.0	0.0	-0.1	0.1	0.0	-0.7	-0.1	-0.1	0.6
0.7	0.1	0.0	0.2	0.2	0.0	0.0	0.0	0.0	-0.1	-0.1	-0.1	1.1
0.8	0.0	0.0	0.2	0.0	0.0	0.0	0.0	0.0	0.0	-0.2	-0.7	1.4
0.9	-0.3	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.1	-0.3	-0.2	0.9
Long Term												
Full Simulation Period ^b	0.0	0.0	0.2	0.1	0.0	0.0	0.0	0.0	-0.3	-0.1	-0.2	0.7
Water Year Types ^c												
Wet (32%)	0.0	-0.1	0.2	0.1	0.0	0.0	0.0	0.0	-0.2	0.1	-0.5	1.6
Above Normal (16%)	0.0	-0.1	0.0	0.1	-0.1	0.0	0.0	0.0	-0.6	-0.3	0.3	0.9
Below Normal (13%)	0.2	0.2	0.3	0.3	0.0	0.0	-0.1	-0.1	-0.7	-0.2	-0.8	-0.1
Dry (24%)	0.1	0.0	0.1	0.1	0.0	0.0	0.1	0.1	-0.2	0.0	-0.2	-0.1
Critical (15%)	0.0	0.1	0.0	0.0	0.0	0.0	-0.2	0.0	0.4	-0.1	0.1	0.4

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-14-3. American River at the Mouth, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	68	58	52	49	51	59	66	71	76	76	77	74
20%	66	58	51	48	51	57	62	70	73	72	76	73
30%	65	58	51	48	50	55	61	68	71	72	73	71
40%	65	57	50	47	49	53	60	67	70	71	72	70
50%	65	57	50	47	48	53	59	65	68	70	71	70
60%	64	57	49	47	48	51	58	63	68	70	71	69
70%	64	57	49	46	47	51	57	62	66	69	71	68
80%	63	56	48	46	47	50	55	61	65	69	70	67
90%	62	56	47	45	47	50	54	58	64	69	69	67
Long Term												
Full Simulation Period ^b	65	57	50	47	49	53	59	65	69	72	72	70
Water Year Types ^c												
Wet (32%)	61	55	47	46	47	51	56	61	66	70	70	67
Above Normal (16%)	65	57	50	47	48	51	58	65	69	69	71	69
Below Normal (13%)	64	56	50	47	49	54	61	67	71	70	73	71
Dry (24%)	65	57	50	47	50	55	61	67	71	72	74	72
Critical (15%)	66	58	50	48	52	58	64	69	73	78	76	74

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	68	58	52	49	51	59	66	71	77	76	77	74
20%	66	58	51	48	51	57	63	70	73	72	75	73
30%	65	58	51	48	50	55	61	68	71	71	73	71
40%	65	57	50	47	49	53	60	67	70	71	72	70
50%	65	57	50	47	48	53	59	65	68	70	71	70
60%	64	57	49	47	48	51	58	63	68	70	71	69
70%	64	57	49	46	47	51	56	62	66	69	71	68
80%	63	56	48	45	47	50	55	61	65	69	70	67
90%	62	56	47	45	47	50	54	58	64	68	69	67
Long Term												
Full Simulation Period ^b	65	57	50	47	49	53	59	65	69	71	72	70
Water Year Types ^c												
Wet (32%)	61	55	47	46	47	51	56	61	66	70	70	67
Above Normal (16%)	65	57	50	47	48	51	58	65	69	69	71	69
Below Normal (13%)	64	56	50	47	49	54	61	67	71	70	74	71
Dry (24%)	65	57	50	47	50	55	61	67	71	72	74	72
Critical (15%)	66	58	50	48	52	58	65	70	73	77	76	74

Alternative 5 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.0	-0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.3	-0.2	0.0	0.2
0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.5	0.3	-0.1	-0.1	-0.2	0.0
0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3	-0.1	-0.3	-0.1	0.2
0.4	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.3	-0.2	0.0
0.5	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	0.0
0.6	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	-0.1	0.0	0.0
0.7	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	-0.1	-0.1	0.0	0.0
0.8	0.2	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	-0.1	0.3	0.0
0.9	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	0.1	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	-0.2	0.0	0.1
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.2	0.2	0.0
Above Normal (16%)	0.0	-0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0
Below Normal (13%)	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.2	0.1	-0.1	0.1	0.1
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3	0.1	-0.3	-0.1	0.0
Critical (15%)	0.0	-0.1	0.0	0.0	0.0	0.0	0.2	0.1	-0.5	-0.4	-0.5	0.6

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-14-4. American River at the Mouth, Monthly Temperature

Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	68	58	52	49	52	59	65	71	75	76	77	74
20%	66	58	51	48	51	57	62	70	73	72	76	73
30%	66	58	51	48	50	55	61	68	71	72	72	72
40%	65	57	50	48	49	53	60	67	69	71	72	71
50%	65	57	50	47	48	53	59	65	68	70	71	70
60%	64	57	49	46	48	51	58	63	67	69	71	70
70%	64	56	49	46	47	51	57	62	66	69	70	69
80%	63	56	48	46	47	50	55	61	65	69	69	69
90%	62	56	47	45	47	50	54	58	64	69	68	68
Long Term												
Full Simulation Period ^b	65	57	50	47	49	53	59	65	69	71	72	71
Water Year Types ^c												
Wet (32%)	61	55	47	46	47	51	56	61	66	70	69	69
Above Normal (16%)	65	57	50	47	48	51	58	65	68	69	71	70
Below Normal (13%)	64	56	50	48	49	54	61	67	69	70	73	71
Dry (24%)	65	57	50	48	50	55	61	67	70	72	74	72
Critical (15%)	66	58	50	48	52	58	64	69	74	78	76	74

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	68	58	52	49	51	59	66	71	76	76	77	74
20%	66	58	51	48	51	57	62	70	73	72	76	73
30%	65	58	51	48	50	55	61	68	71	72	73	71
40%	65	57	50	47	49	53	60	67	70	71	72	70
50%	65	57	50	47	48	53	59	65	68	70	71	70
60%	64	57	49	47	48	51	58	63	68	70	71	69
70%	64	57	49	46	47	51	57	62	66	69	71	68
80%	63	56	48	46	47	50	55	61	65	69	70	67
90%	62	56	47	45	47	50	54	58	64	69	69	67
Long Term												
Full Simulation Period ^b	65	57	50	47	49	53	59	65	69	72	72	70
Water Year Types ^c												
Wet (32%)	61	55	47	46	47	51	56	61	66	70	70	67
Above Normal (16%)	65	57	50	47	48	51	58	65	69	69	71	69
Below Normal (13%)	64	56	50	47	49	54	61	67	71	70	73	71
Dry (24%)	65	57	50	47	50	55	61	67	71	72	74	72
Critical (15%)	66	58	50	48	52	58	64	69	73	78	76	74

No Action Alternative minus Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.2	0.2	0.0	-0.2	0.0	0.1	0.8	0.4	1.7	-0.4	0.2	-0.2
0.2	0.3	0.0	0.0	0.0	0.1	0.0	0.1	0.1	0.7	0.2	-0.1	-0.3
0.3	-0.3	-0.1	-0.1	-0.1	0.0	0.0	0.0	-0.4	0.0	0.3	0.6	-0.6
0.4	-0.1	0.0	0.0	-0.2	0.1	0.0	0.0	0.2	0.8	0.3	0.3	-0.5
0.5	-0.1	-0.1	0.0	0.0	0.1	0.0	0.0	0.0	0.2	0.2	0.1	-0.2
0.6	0.1	0.0	-0.4	0.0	0.0	0.1	-0.1	-0.1	0.3	0.3	0.3	-0.7
0.7	-0.1	0.0	-0.4	-0.2	0.0	0.0	-0.1	0.0	0.0	0.3	0.1	-1.2
0.8	0.0	0.1	-0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.5	-1.6
0.9	0.3	0.2	-0.1	-0.1	0.0	0.0	0.0	0.0	-0.1	0.0	0.6	-1.6
Long Term												
Full Simulation Period ^b	-0.1	0.0	-0.1	-0.1	0.0	0.0	0.1	0.0	0.3	0.2	0.3	-0.7
Water Year Types ^c												
Wet (32%)	0.0	0.1	-0.2	-0.1	0.0	0.0	0.0	0.0	0.1	0.1	0.6	-1.7
Above Normal (16%)	0.1	0.2	-0.1	-0.2	0.1	0.0	0.0	0.0	0.5	0.2	-0.1	-0.8
Below Normal (13%)	-0.2	-0.1	-0.3	-0.2	0.1	0.0	0.3	-0.1	2.0	0.4	0.5	-0.1
Dry (24%)	-0.2	0.0	0.0	-0.1	0.0	0.0	0.0	-0.1	0.2	0.4	-0.1	0.0
Critical (15%)	0.0	-0.2	-0.1	-0.1	0.0	0.0	0.4	0.1	-0.6	-0.1	0.3	-0.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-14-5. American River at the Mouth, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	68	58	52	49	52	59	65	71	75	76	77	74
20%	66	58	51	48	51	57	62	70	73	72	76	73
30%	66	58	51	48	50	55	61	68	71	72	72	72
40%	65	57	50	48	49	53	60	67	69	71	72	71
50%	65	57	50	47	48	53	59	65	68	70	71	70
60%	64	57	49	46	48	51	58	63	67	69	71	70
70%	64	56	49	46	47	51	57	62	66	69	70	69
80%	63	56	48	46	47	50	55	61	65	69	69	69
90%	62	56	47	45	47	50	54	58	64	69	68	68
Long Term												
Full Simulation Period ^b	65	57	50	47	49	53	59	65	69	71	72	71
Water Year Types ^c												
Wet (32%)	61	55	47	46	47	51	56	61	66	70	69	69
Above Normal (16%)	65	57	50	47	48	51	58	65	68	69	71	70
Below Normal (13%)	64	56	50	48	49	54	61	67	69	70	73	71
Dry (24%)	65	57	50	48	50	55	61	67	70	72	74	72
Critical (15%)	66	58	50	48	52	58	64	69	74	78	76	74

Alternative 3

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	68	59	52	49	52	59	66	71	76	76	77	74
20%	66	58	51	48	51	57	62	70	72	72	75	73
30%	66	58	51	48	50	55	61	68	71	72	73	71
40%	65	57	50	48	49	53	60	67	70	71	72	71
50%	65	57	50	47	48	53	59	65	68	70	72	70
60%	64	57	50	47	48	51	58	63	67	70	71	70
70%	64	56	49	46	47	51	57	62	66	69	70	69
80%	63	56	48	46	47	50	55	61	65	69	69	69
90%	62	56	47	45	47	50	54	58	64	68	68	68
Long Term												
Full Simulation Period ^b	65	57	50	47	49	53	59	65	69	71	72	71
Water Year Types ^c												
Wet (32%)	61	55	47	46	47	51	56	61	65	70	69	69
Above Normal (16%)	65	57	50	47	48	51	58	65	68	69	71	70
Below Normal (13%)	64	57	50	48	49	54	61	67	70	70	73	71
Dry (24%)	65	57	50	48	50	55	61	67	71	72	73	72
Critical (15%)	66	58	50	48	52	58	64	69	74	78	76	74

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.1	0.2	0.0	0.1	0.0	0.0	0.5	0.0	1.1	-0.4	0.3	0.0
0.2	0.0	0.1	0.0	0.1	-0.1	0.0	0.1	0.1	-0.4	0.4	-0.5	-0.2
0.3	-0.1	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.6	-0.2
0.4	-0.1	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.7	0.3	0.1	-0.1
0.5	-0.1	0.0	0.1	0.0	0.0	0.0	0.0	-0.3	-0.1	0.3	0.2	-0.1
0.6	0.1	0.0	0.1	0.1	0.0	0.0	0.0	-0.1	-0.5	0.2	0.2	-0.1
0.7	0.0	0.0	-0.2	0.0	0.0	0.0	-0.1	0.0	0.0	0.2	0.0	-0.1
0.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.2	-0.1
0.9	0.0	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.3	0.4	-0.7
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.1	0.1	0.1	-0.1
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.2	0.2	0.2	-0.1
Above Normal (16%)	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.2	0.1
Below Normal (13%)	0.0	0.1	0.0	0.0	0.0	0.0	0.2	-0.2	1.3	0.2	-0.2	-0.3
Dry (24%)	-0.1	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.4	-0.3	-0.1
Critical (15%)	0.0	-0.1	-0.1	0.0	0.0	-0.1	0.2	0.0	-0.2	-0.2	0.5	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-14-6. American River at the Mouth, Monthly Temperature

Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	68	58	52	49	52	59	65	71	75	76	77	74
20%	66	58	51	48	51	57	62	70	73	72	76	73
30%	66	58	51	48	50	55	61	68	71	72	72	72
40%	65	57	50	48	49	53	60	67	69	71	72	71
50%	65	57	50	47	48	53	59	65	68	70	71	70
60%	64	57	49	46	48	51	58	63	67	69	71	70
70%	64	56	49	46	47	51	57	62	66	69	70	69
80%	63	56	48	46	47	50	55	61	65	69	69	69
90%	62	56	47	45	47	50	54	58	64	69	68	68
Long Term												
Full Simulation Period ^b	65	57	50	47	49	53	59	65	69	71	72	71
Water Year Types ^c												
Wet (32%)	61	55	47	46	47	51	56	61	66	70	69	69
Above Normal (16%)	65	57	50	47	48	51	58	65	68	69	71	70
Below Normal (13%)	64	56	50	48	49	54	61	67	69	70	73	71
Dry (24%)	65	57	50	48	50	55	61	67	70	72	74	72
Critical (15%)	66	58	50	48	52	58	64	69	74	78	76	74

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	68	58	52	49	51	59	66	71	77	76	77	74
20%	66	58	51	48	51	57	63	70	73	72	75	73
30%	65	58	51	48	50	55	61	68	71	71	73	71
40%	65	57	50	47	49	53	60	67	70	71	72	70
50%	65	57	50	47	48	53	59	65	68	70	71	70
60%	64	57	49	47	48	51	58	63	68	70	71	69
70%	64	57	49	46	47	51	56	62	66	69	71	68
80%	63	56	48	45	47	50	55	61	65	69	70	67
90%	62	56	47	45	47	50	54	58	64	68	69	67
Long Term												
Full Simulation Period ^b	65	57	50	47	49	53	59	65	69	71	72	70
Water Year Types ^c												
Wet (32%)	61	55	47	46	47	51	56	61	66	70	70	67
Above Normal (16%)	65	57	50	47	48	51	58	65	69	69	71	69
Below Normal (13%)	64	56	50	47	49	54	61	67	71	70	74	71
Dry (24%)	65	57	50	47	50	55	61	67	71	72	74	72
Critical (15%)	66	58	50	48	52	58	65	70	73	77	76	74

Alternative 5 minus Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.1	0.1	0.0	-0.2	0.0	0.2	0.9	0.4	2.0	-0.5	0.2	0.0
0.2	0.3	0.0	0.0	0.0	0.1	0.0	0.6	0.4	0.5	0.1	-0.2	-0.3
0.3	-0.3	-0.1	-0.1	-0.1	0.1	0.0	0.0	-0.1	0.0	0.0	0.5	-0.4
0.4	-0.1	-0.1	0.0	-0.2	0.1	0.0	0.0	0.2	0.7	0.0	0.1	-0.5
0.5	-0.2	-0.1	0.0	0.0	0.1	0.0	0.0	0.0	0.2	0.1	0.1	-0.3
0.6	0.0	0.0	-0.3	0.0	0.0	0.0	-0.1	0.0	0.2	0.2	0.3	-0.7
0.7	-0.2	0.1	-0.4	-0.2	0.0	0.0	-0.1	0.0	-0.1	0.2	0.1	-1.2
0.8	0.2	0.0	-0.2	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.8	-1.6
0.9	0.4	0.2	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	-0.1	0.7	-1.6
Long Term												
Full Simulation Period ^b	-0.1	0.0	-0.2	-0.1	0.0	0.0	0.1	0.1	0.3	0.0	0.2	-0.6
Water Year Types ^c												
Wet (32%)	0.0	0.0	-0.2	-0.1	0.0	0.0	0.0	0.0	0.1	-0.1	0.8	-1.7
Above Normal (16%)	0.1	0.0	-0.1	-0.2	0.1	0.0	0.0	0.0	0.5	0.2	-0.1	-0.8
Below Normal (13%)	-0.2	0.0	-0.4	-0.3	0.0	0.0	0.4	0.0	2.1	0.3	0.6	0.0
Dry (24%)	-0.2	0.0	0.0	-0.1	0.0	0.0	0.0	0.2	0.3	0.1	-0.2	0.0
Critical (15%)	0.0	-0.2	-0.1	-0.1	0.0	0.0	0.6	0.2	-1.1	-0.5	-0.2	0.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


B.15. Stanislaus River below New Melones Temperature

Figure B-15-1. Stanislaus River below New Melones Reservoir, October

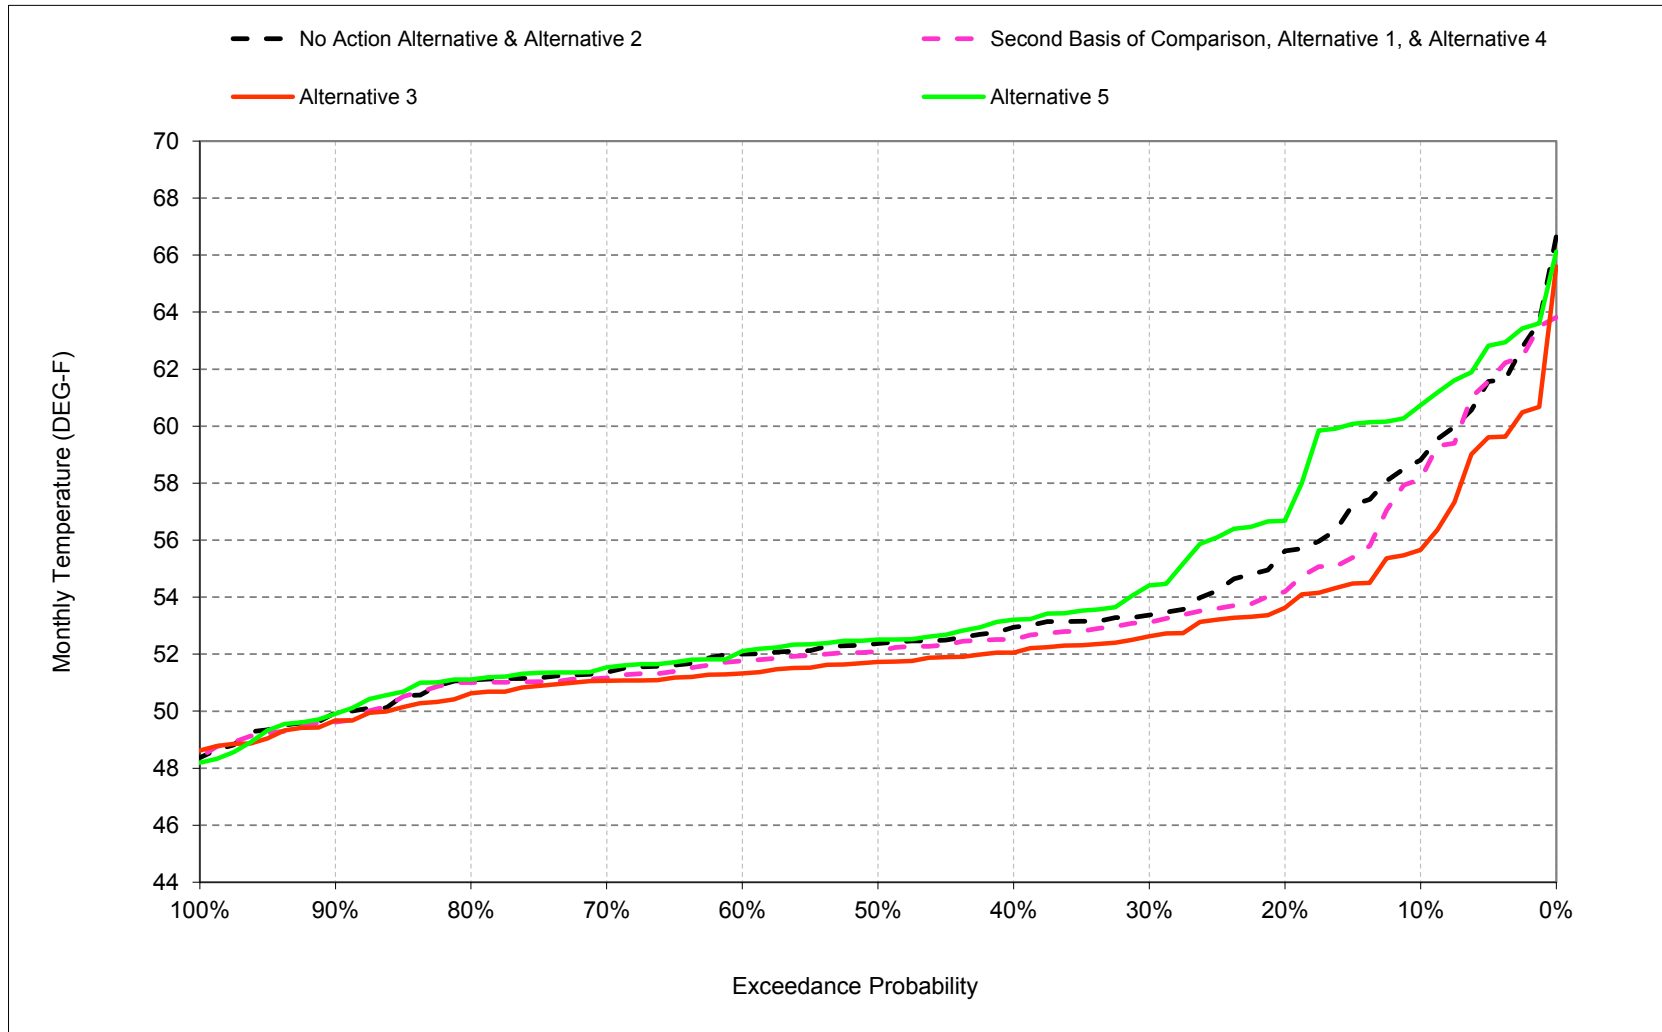


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-15-2. Stanislaus River below New Melones Reservoir, November

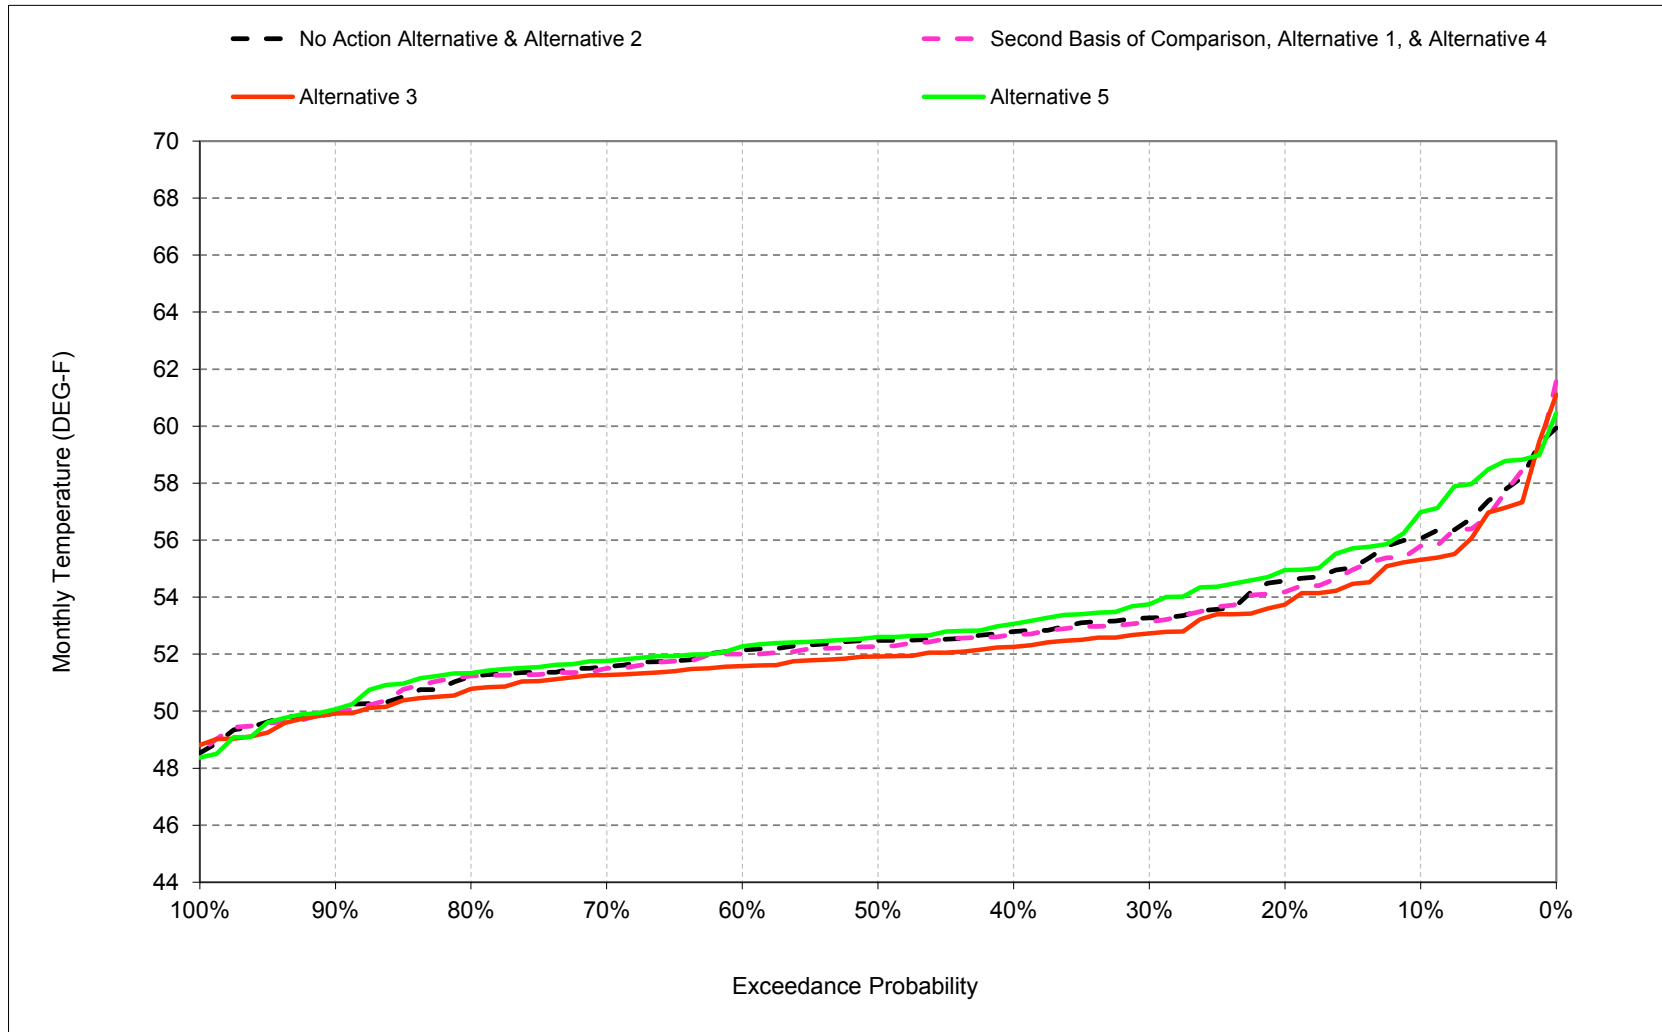


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-15-3. Stanislaus River below New Melones Reservoir, December

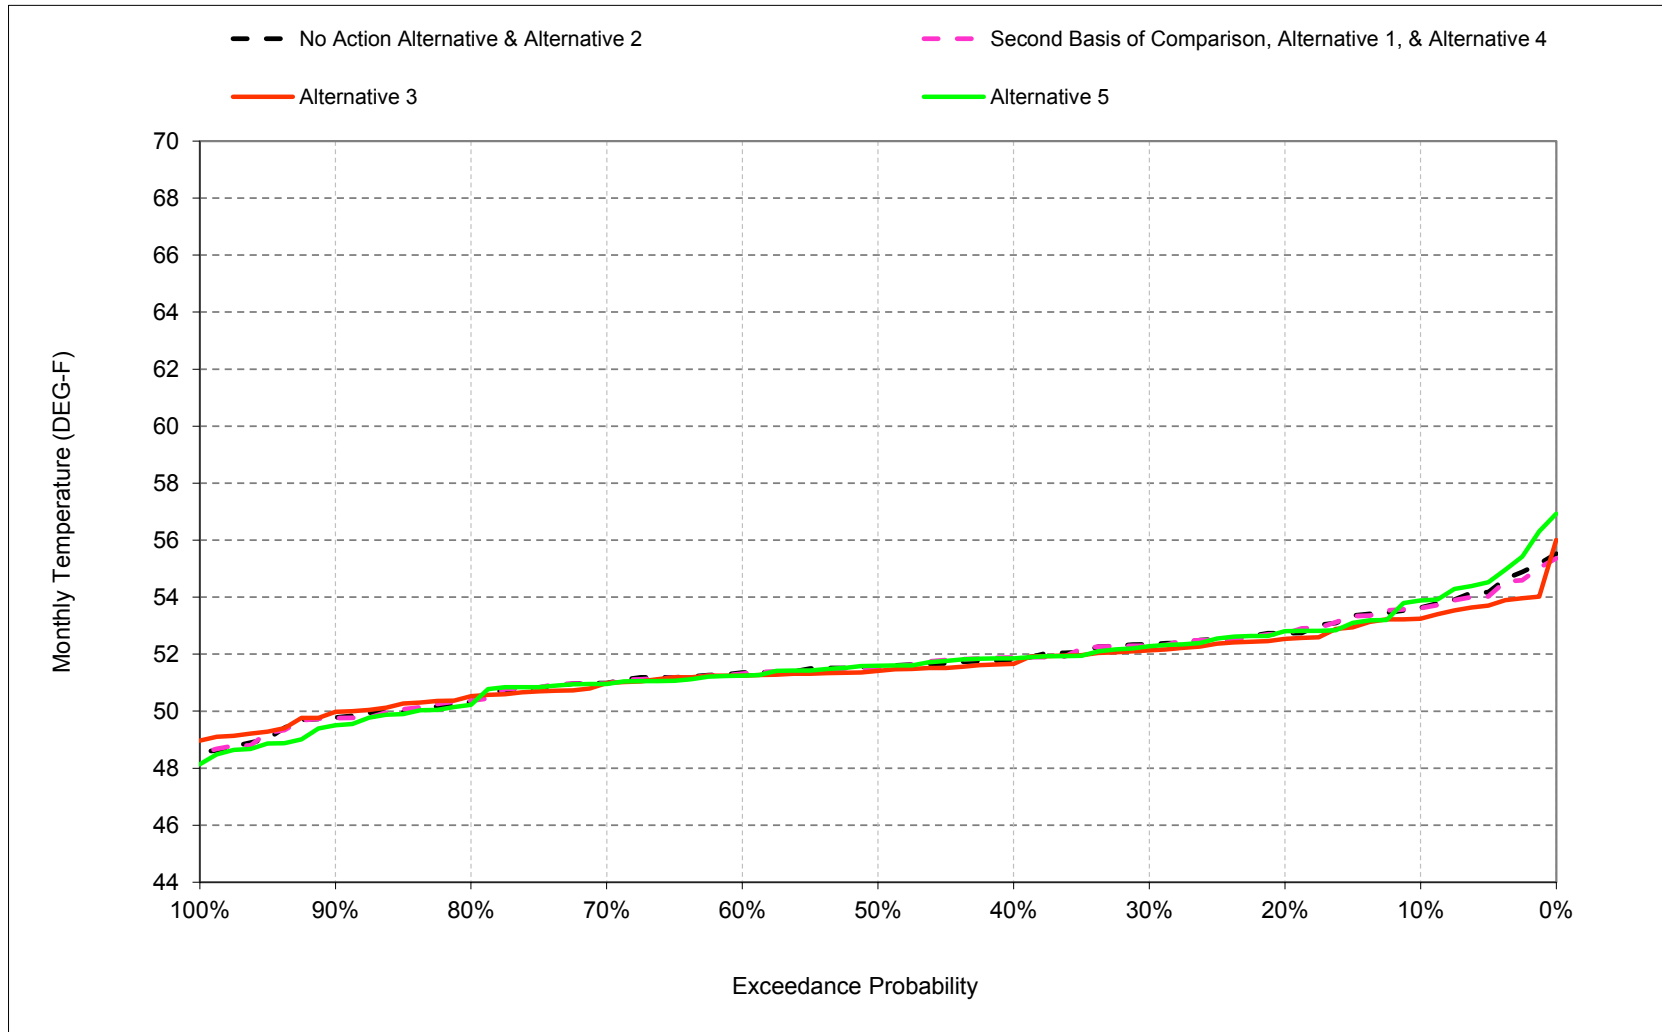


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-15-4. Stanislaus River below New Melones Reservoir, January

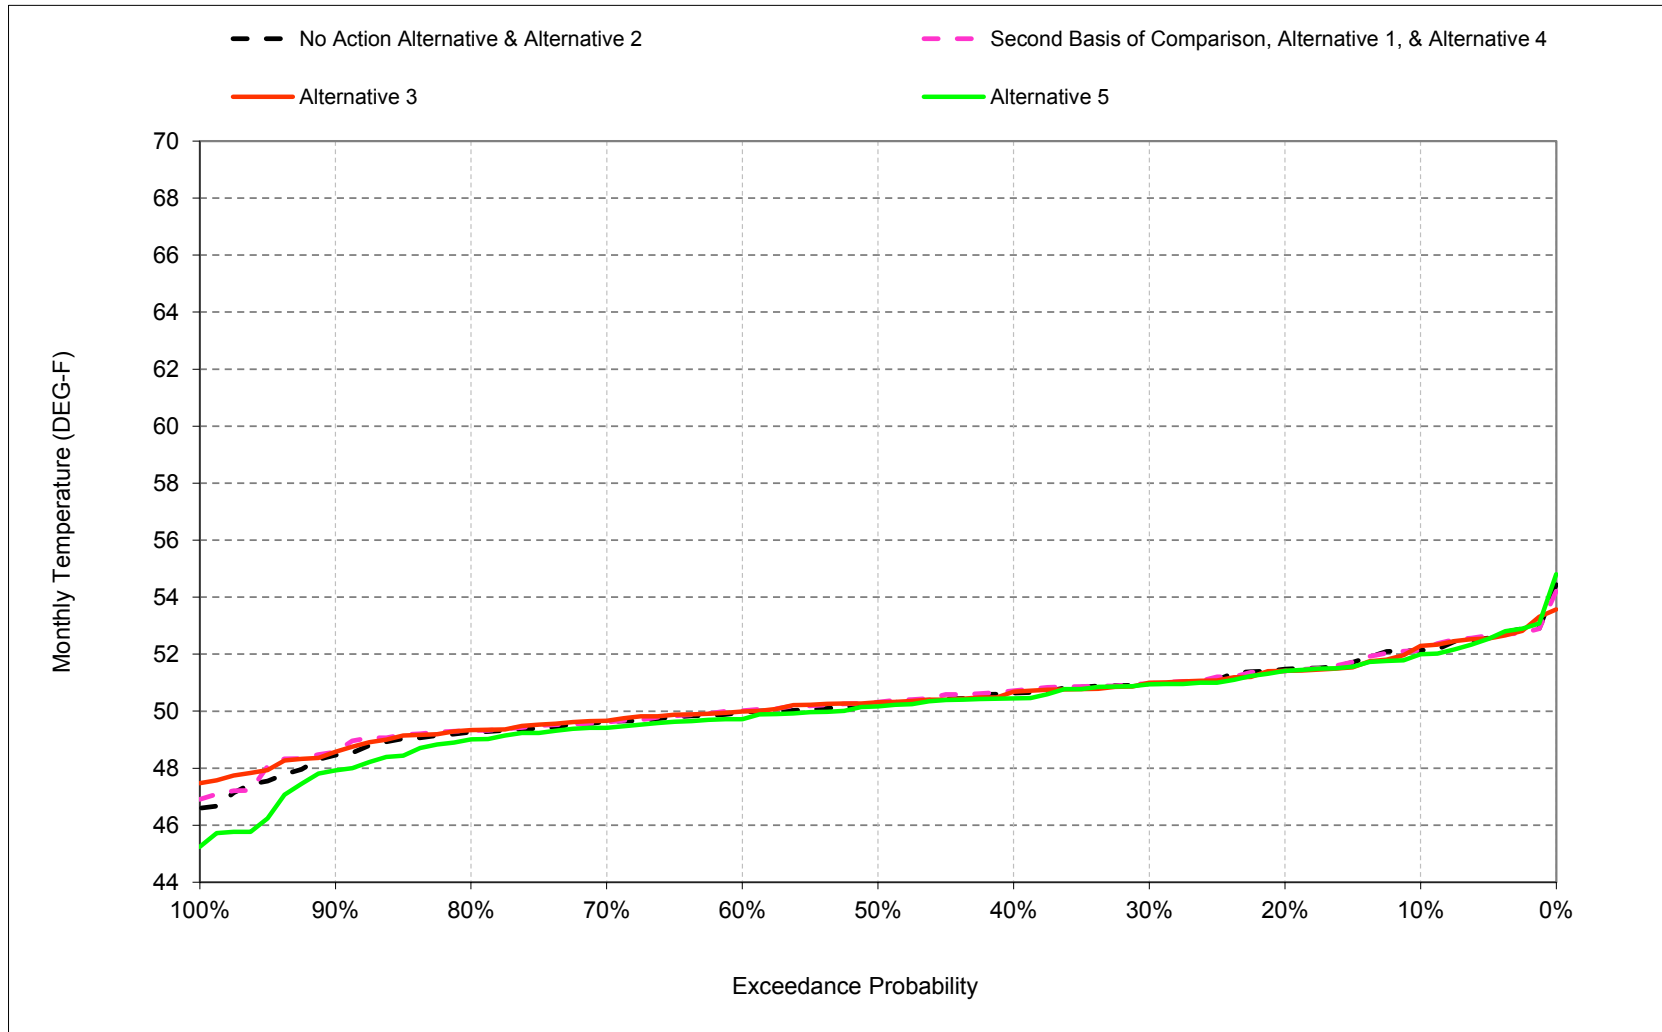


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-15-5. Stanislaus River below New Melones Reservoir, February

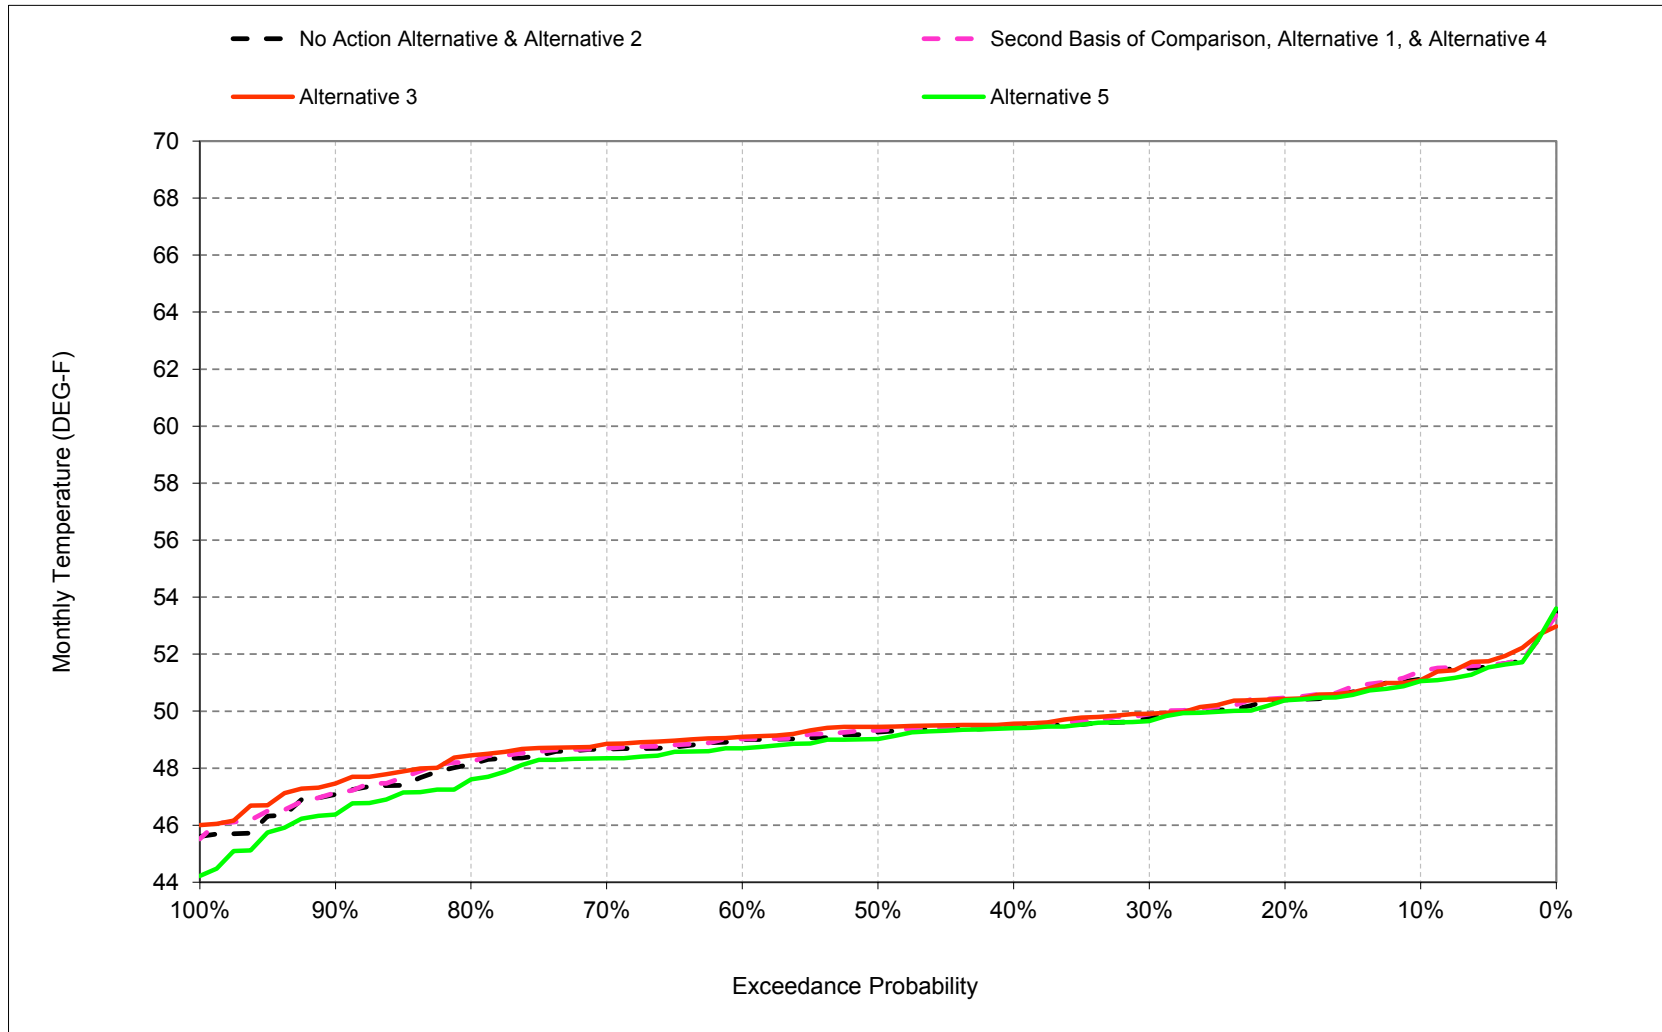


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-15-6. Stanislaus River below New Melones Reservoir, March

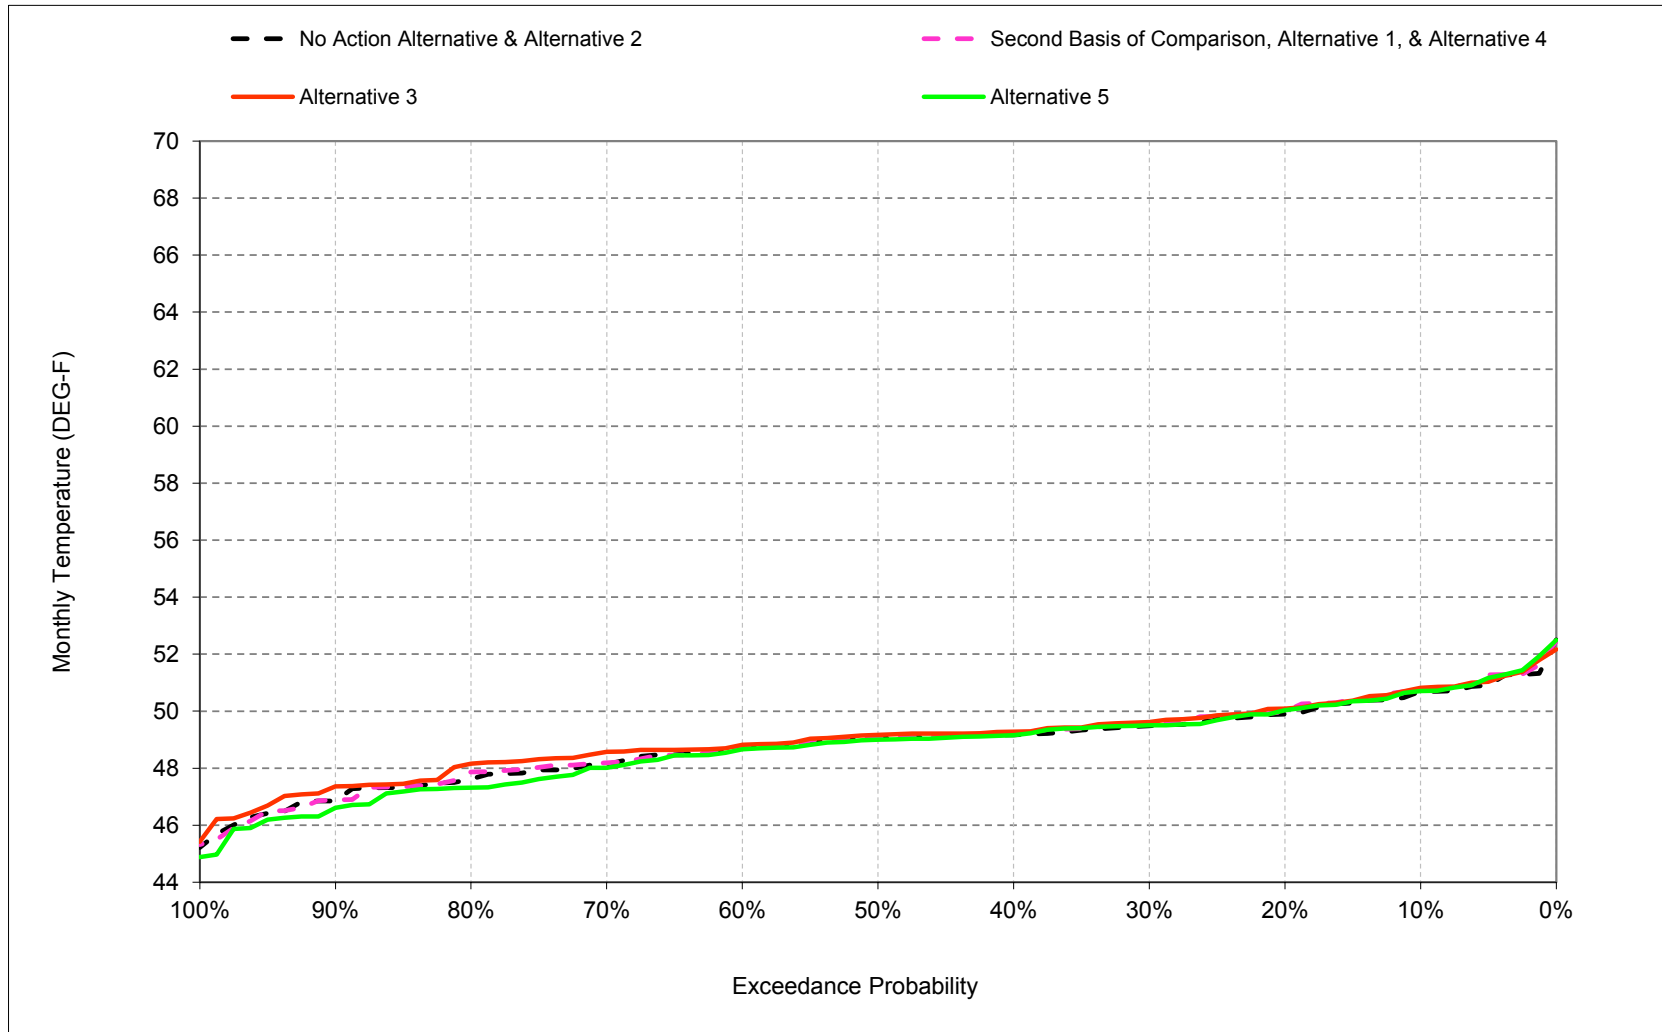


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-15-7. Stanislaus River below New Melones Reservoir, April

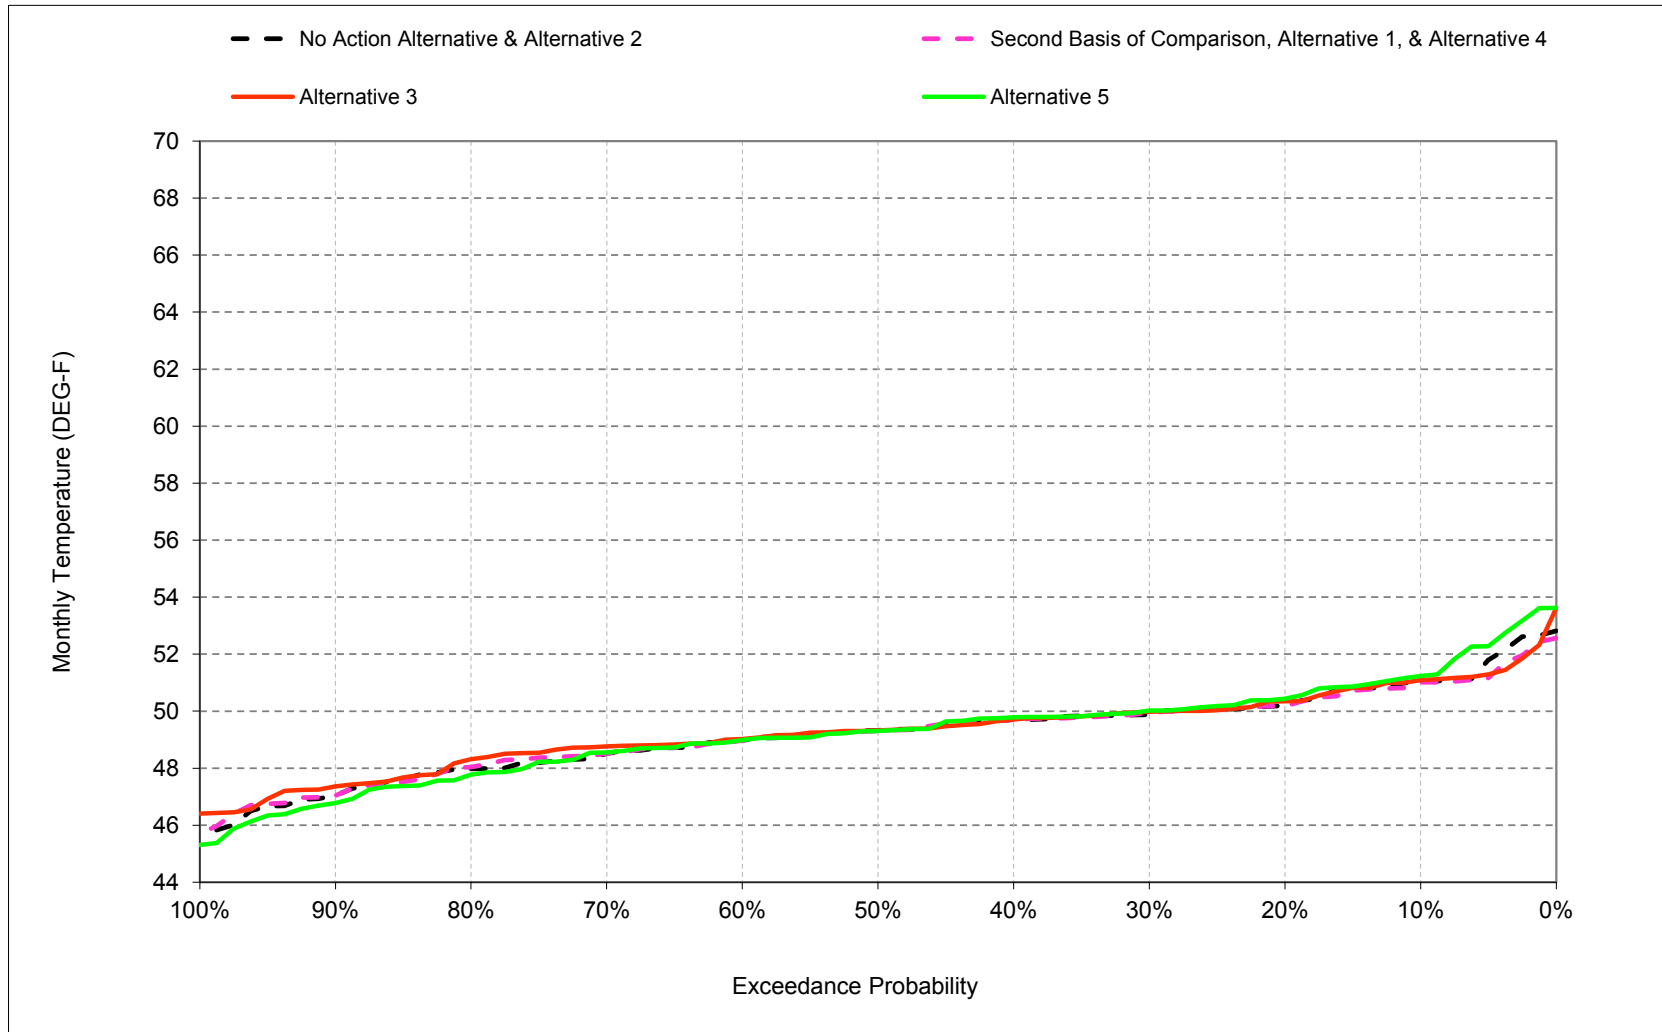


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-15-8. Stanislaus River below New Melones Reservoir, May

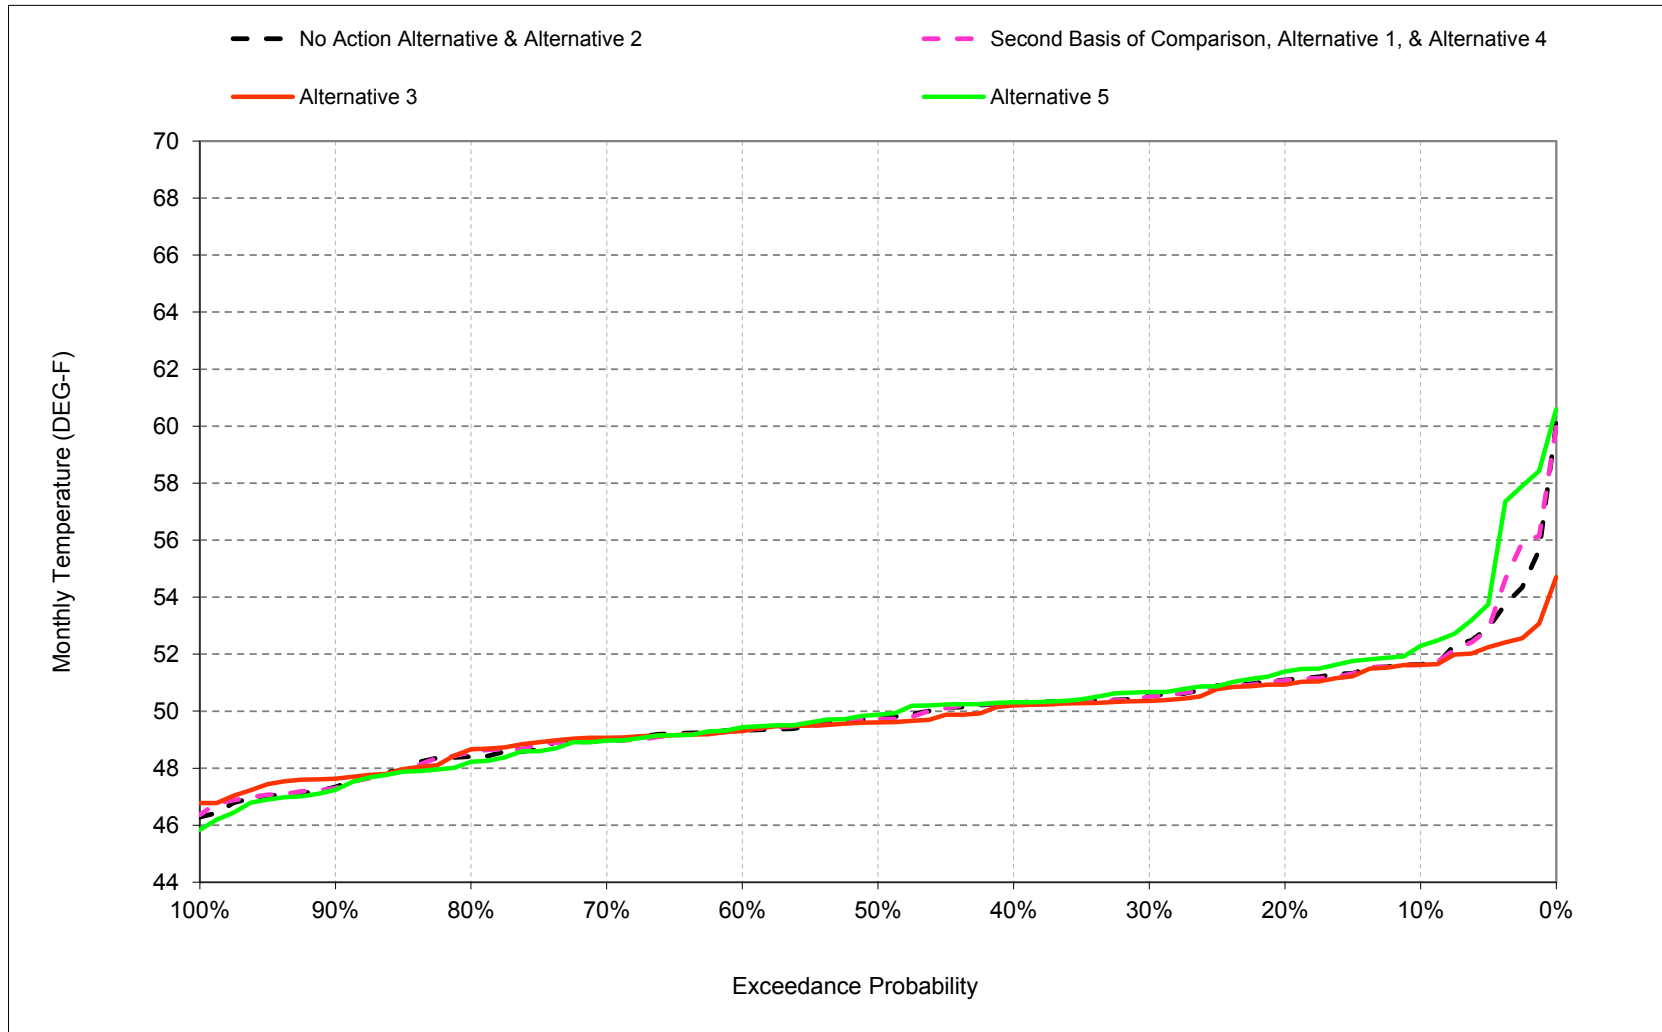


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-15-9. Stanislaus River below New Melones Reservoir, June

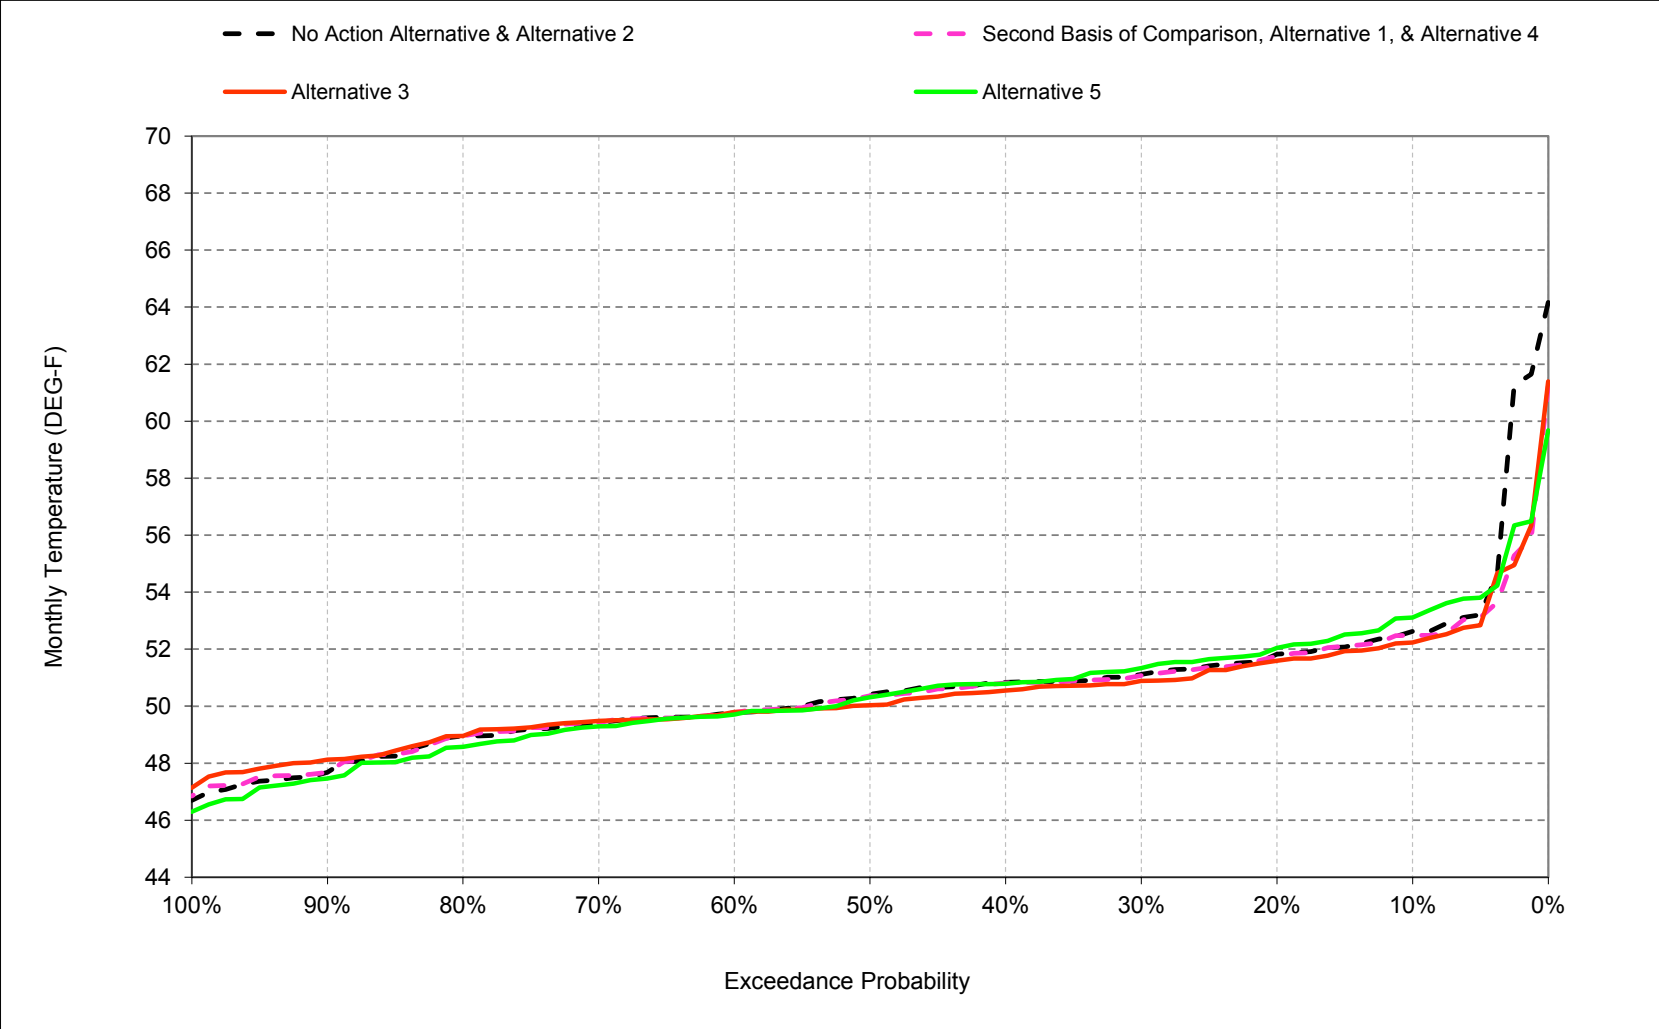


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-15-10. Stanislaus River below New Melones Reservoir, July

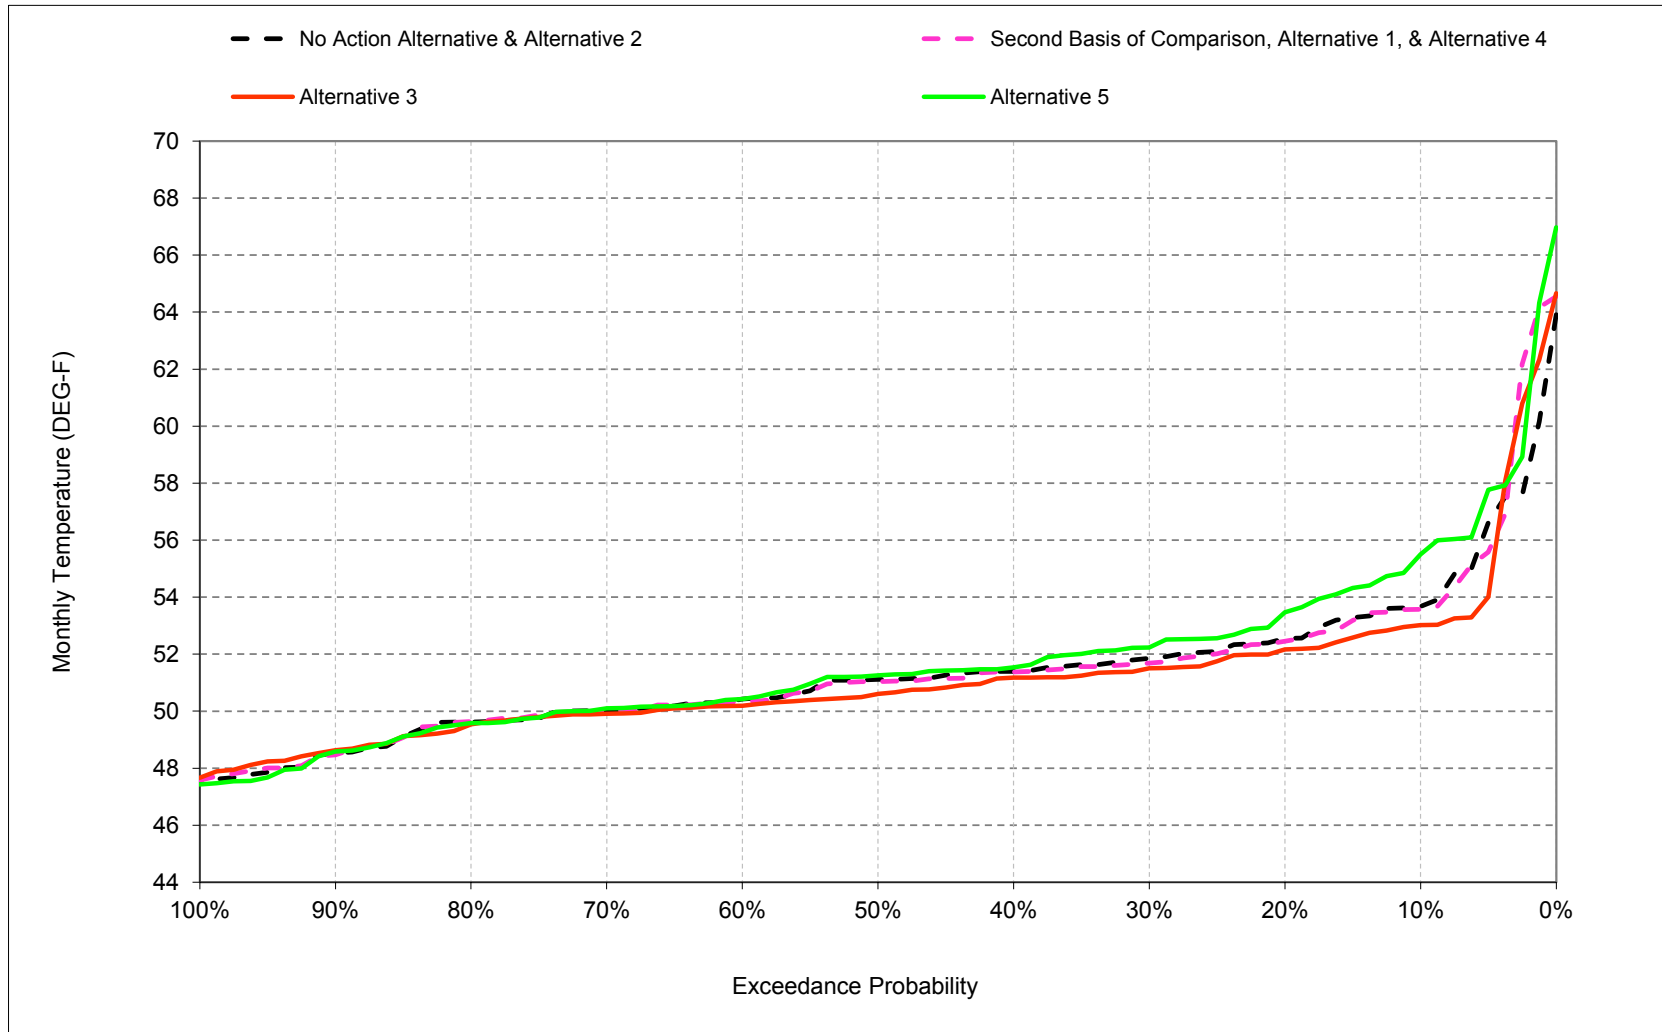


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-15-11. Stanislaus River below New Melones Reservoir, August

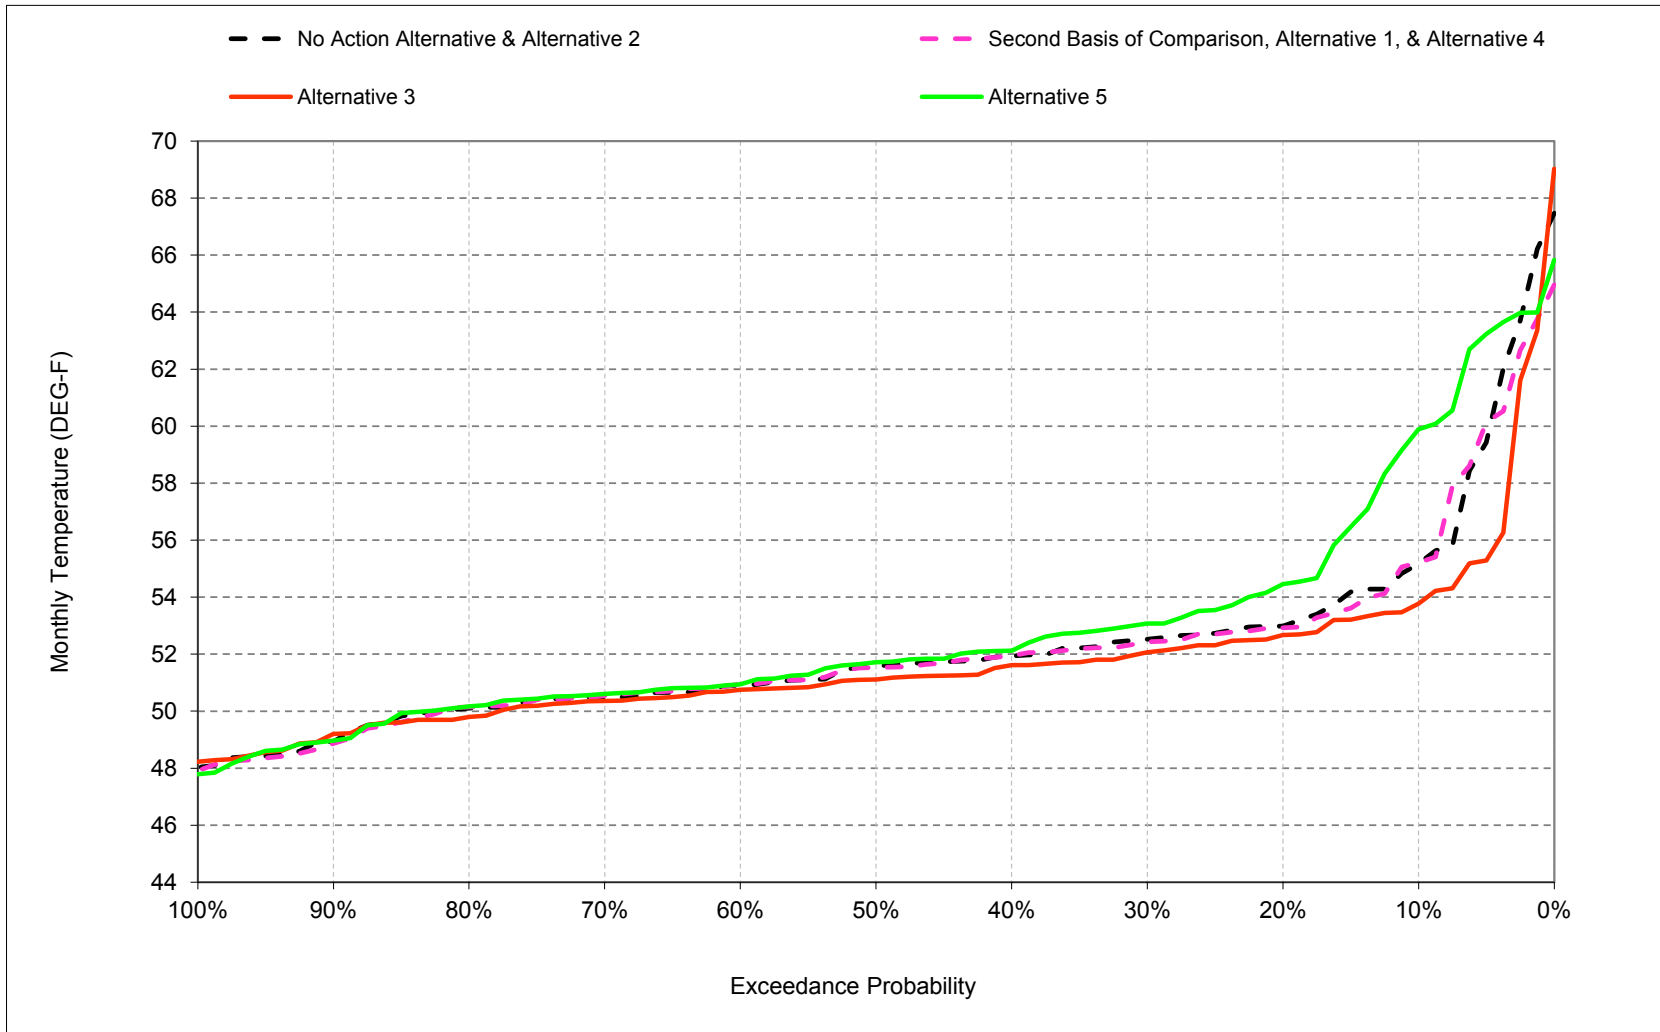

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-15-12. Stanislaus River below New Melones Reservoir, September

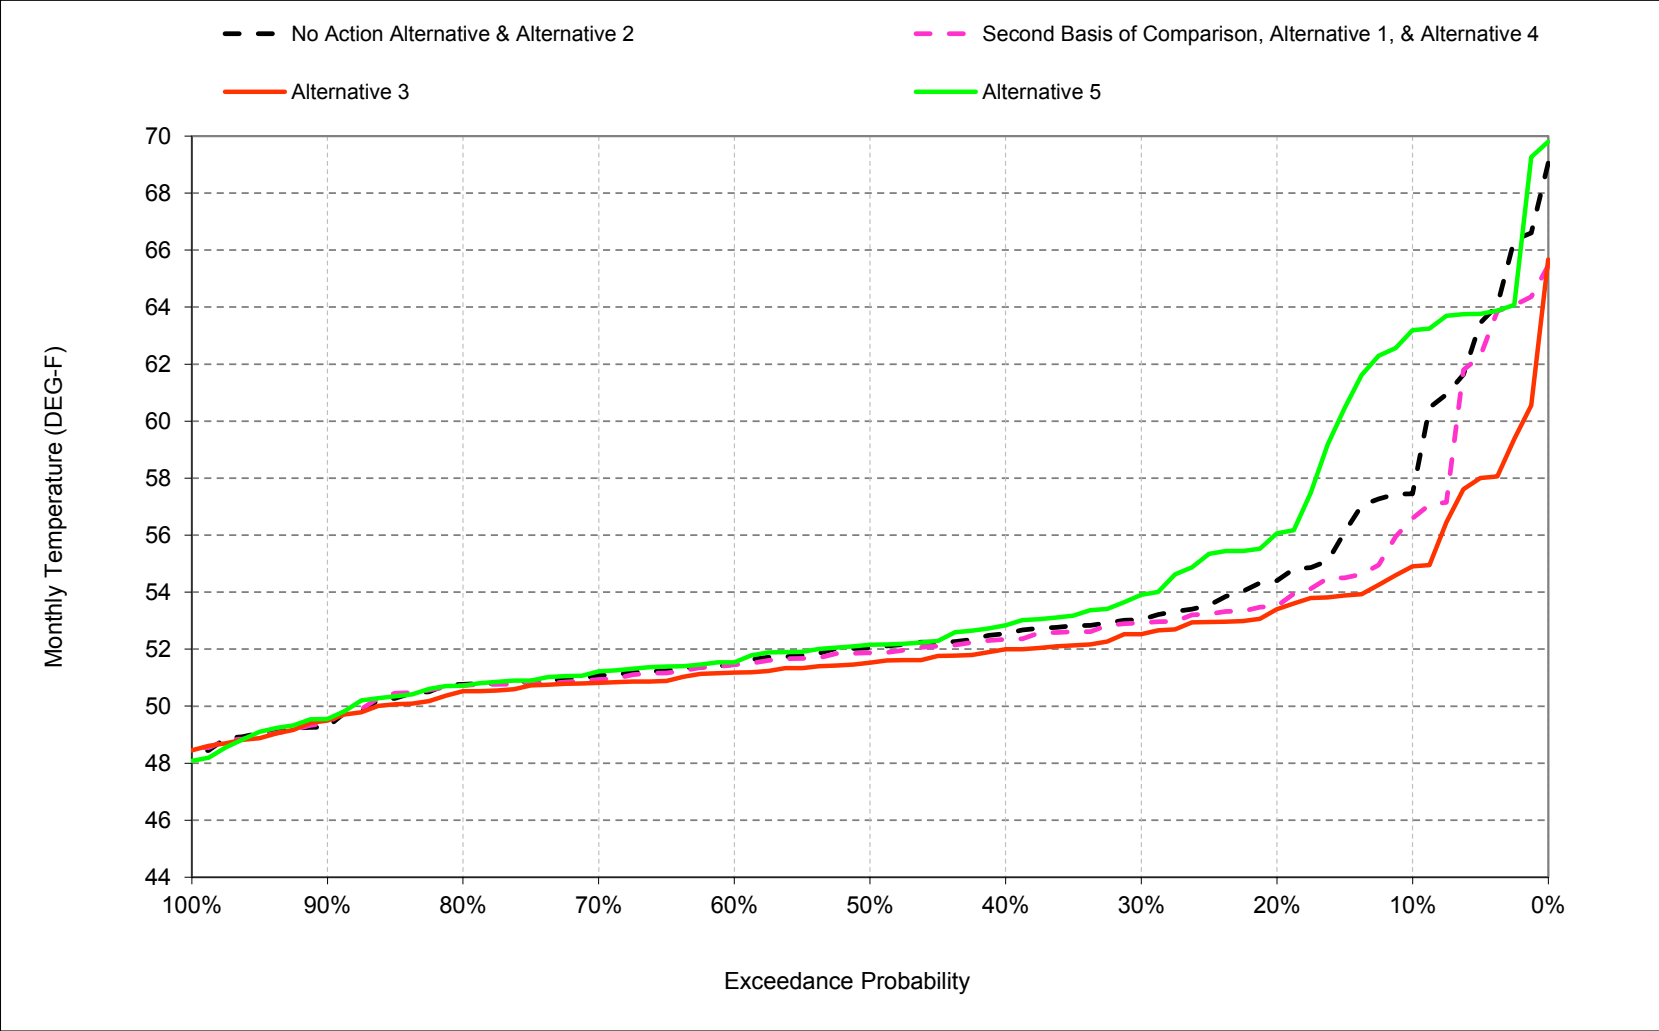

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-15-1. Stanislaus River below New Melones Reservoir, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	59	56	54	52	51	51	51	52	53	54	55	57
20%	56	55	53	51	50	50	50	51	52	53	53	54
30%	53	53	52	51	50	49	50	51	51	52	53	53
40%	53	53	52	51	49	49	50	50	51	51	52	53
50%	52	52	52	50	49	49	49	50	50	51	52	52
60%	52	52	51	50	49	49	49	49	50	50	51	51
70%	51	52	51	50	49	48	48	49	49	50	50	51
80%	51	51	50	49	48	48	48	48	49	50	50	51
90%	50	50	50	48	47	47	47	47	48	48	49	49
Long Term												
Full Simulation Period ^b	53	53	52	50	49	49	49	50	51	51	52	53
Water Year Types ^c												
Wet (32%)	50	50	49	49	48	48	48	48	49	49	50	50
Above Normal (16%)	53	53	52	50	49	48	49	49	50	50	51	52
Below Normal (13%)	53	52	52	51	49	49	49	50	50	51	52	52
Dry (24%)	53	53	52	51	50	50	50	50	51	52	53	54
Critical (15%)	57	54	52	50	50	50	51	53	55	56	57	60

Alternative 1												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	58	56	54	52	51	51	51	52	52	54	55	57
20%	54	54	53	51	50	50	50	51	52	52	53	54
30%	53	53	52	51	50	50	50	50	51	52	52	53
40%	53	53	52	51	49	49	50	50	51	51	52	52
50%	52	52	52	50	49	49	49	50	50	51	52	52
60%	52	52	51	50	49	49	49	49	50	50	51	51
70%	51	52	51	50	49	48	48	49	49	50	50	51
80%	51	51	50	49	48	48	48	48	49	50	50	51
90%	50	50	50	48	47	47	47	47	48	48	49	49
Long Term												
Full Simulation Period ^b	53	53	52	50	49	49	49	50	50	51	52	53
Water Year Types ^c												
Wet (32%)	50	50	49	49	48	48	48	48	49	49	50	50
Above Normal (16%)	53	53	52	50	49	48	49	49	50	50	51	52
Below Normal (13%)	52	52	51	51	49	49	49	50	50	51	52	52
Dry (24%)	53	53	52	51	50	50	50	50	51	52	53	54
Critical (15%)	57	55	53	51	50	50	51	53	53	56	57	58

Alternative 1 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.7	-0.3	0.0	0.0	0.3	0.1	0.0	0.0	-0.1	-0.1	0.1	-0.9
0.2	-1.4	-0.4	0.0	-0.1	0.1	0.1	0.0	0.0	0.0	-0.1	-0.1	-0.9
0.3	-0.3	-0.1	0.0	0.0	0.1	0.1	0.1	0.0	0.0	-0.2	-0.1	-0.1
0.4	-0.4	-0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.2
0.5	-0.3	-0.2	0.0	0.1	0.1	0.0	0.0	0.0	0.0	-0.1	0.0	-0.2
0.6	-0.2	-0.1	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
0.7	-0.2	-0.1	0.0	0.0	0.0	0.1	0.1	0.0	0.1	0.0	0.0	-0.1
0.8	-0.1	0.0	0.0	0.1	0.2	0.1	0.1	0.1	0.0	0.0	0.1	-0.1
0.9	-0.3	0.0	0.0	0.2	0.0	0.0	0.0	0.0	0.1	0.0	-0.2	0.1
Long Term												
Full Simulation Period ^b	-0.3	-0.1	0.0	0.1	0.1	0.0	0.0	0.0	-0.2	0.1	-0.1	-0.4
Water Year Types ^c												
Wet (32%)	-0.3	-0.2	0.0	0.1	0.1	-0.1	0.1	0.0	0.1	0.0	0.0	0.0
Above Normal (16%)	-0.4	-0.3	-0.1	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	-0.1
Below Normal (13%)	-0.6	-0.4	-0.1	0.1	0.1	0.1	0.0	0.0	-0.1	-0.1	-0.2	-0.3
Dry (24%)	-0.3	-0.3	-0.1	0.0	0.1	0.0	0.0	0.0	0.0	-0.1	-0.2	-0.3
Critical (15%)	-0.1	1.0	0.3	0.3	0.3	0.2	-0.3	0.2	-1.4	0.6	-0.1	-2.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on an 81-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-15-2. Stanislaus River below New Melones Reservoir, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	59	56	54	52	51	51	51	52	53	54	55	57
20%	56	55	53	51	50	50	50	51	52	53	53	54
30%	53	53	52	51	50	49	50	51	51	52	53	53
40%	53	53	52	51	49	49	50	50	51	51	52	53
50%	52	52	52	50	49	49	49	50	50	51	52	52
60%	52	52	51	50	49	49	49	49	50	50	51	51
70%	51	52	51	50	49	48	48	49	49	50	50	51
80%	51	51	50	49	48	48	48	48	49	50	50	51
90%	50	50	50	48	47	47	47	47	48	48	49	49
Long Term												
Full Simulation Period ^b	53	53	52	50	49	49	49	50	51	51	52	53
Water Year Types ^c												
Wet (32%)	50	50	49	49	48	48	48	48	49	49	50	50
Above Normal (16%)	53	53	52	50	49	48	49	49	50	50	51	52
Below Normal (13%)	53	52	52	51	49	49	49	50	50	51	52	52
Dry (24%)	53	53	52	51	50	50	50	50	51	52	53	54
Critical (15%)	57	54	52	50	50	50	51	53	55	56	57	60

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	56	55	53	52	51	51	51	52	52	53	54	55
20%	54	54	53	51	50	50	50	51	52	52	53	53
30%	53	53	52	51	50	50	50	50	51	51	52	53
40%	52	52	52	51	50	49	50	50	51	51	52	52
50%	52	52	51	50	49	49	49	50	50	51	51	51
60%	51	52	51	50	49	49	49	49	50	50	51	51
70%	51	51	51	50	49	49	49	49	49	50	50	51
80%	51	51	51	49	48	48	48	48	49	49	50	50
90%	50	50	50	48	47	47	47	48	48	49	49	49
Long Term												
Full Simulation Period ^b	52	52	52	50	49	49	49	50	50	51	52	52
Water Year Types ^c												
Wet (32%)	49	50	49	49	48	48	48	49	49	49	50	50
Above Normal (16%)	52	52	51	50	49	49	49	49	50	50	51	51
Below Normal (13%)	52	51	51	50	49	49	49	50	50	51	51	52
Dry (24%)	52	52	52	51	50	50	50	50	51	51	52	53
Critical (15%)	56	55	53	51	50	50	51	52	54	56	56	57

Alternative 3 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-3.2	-0.7	-0.4	0.1	0.0	0.1	0.1	0.0	-0.4	-0.7	-1.4	-2.6
0.2	-2.0	-0.8	-0.2	0.0	0.0	0.2	0.2	-0.2	-0.2	-0.4	-0.3	-1.1
0.3	-0.8	-0.5	-0.2	0.0	0.2	0.1	0.1	-0.1	-0.2	-0.4	-0.5	-0.5
0.4	-0.9	-0.5	-0.2	0.0	0.1	0.1	0.0	-0.1	-0.3	-0.2	-0.3	-0.6
0.5	-0.7	-0.6	-0.1	0.1	0.2	0.1	0.0	-0.1	-0.3	-0.6	-0.5	-0.5
0.6	-0.7	-0.6	-0.1	0.1	0.1	0.1	0.1	0.0	0.0	-0.2	-0.2	-0.3
0.7	-0.3	-0.3	0.0	0.1	0.1	0.4	0.4	0.1	0.1	-0.1	-0.1	-0.2
0.8	-0.5	-0.4	0.2	0.1	0.3	0.5	0.2	0.1	0.0	-0.3	-0.3	-0.3
0.9	-0.3	0.0	0.2	0.1	0.4	0.3	0.3	0.4	0.5	0.1	0.0	0.2
Long Term												
Full Simulation Period ^b	-0.9	-0.4	-0.1	0.1	0.2	0.2	0.1	-0.1	-0.2	-0.2	-0.5	-1.0
Water Year Types ^c												
Wet (32%)	-0.6	-0.5	-0.1	0.0	0.2	0.1	0.2	0.1	0.1	0.0	-0.1	-0.1
Above Normal (16%)	-1.0	-0.8	-0.3	0.0	0.2	0.2	0.2	0.1	0.0	-0.2	-0.4	-0.5
Below Normal (13%)	-1.3	-1.0	-0.5	-0.1	0.1	0.2	0.1	0.0	-0.2	-0.3	-0.5	-0.6
Dry (24%)	-0.7	-0.5	-0.2	-0.1	0.0	0.1	0.1	-0.1	-0.3	-0.5	-0.8	-1.2
Critical (15%)	-1.6	0.7	0.5	0.8	0.8	0.5	-0.2	-1.2	-1.1	-0.1	-1.1	-3.6

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-15-3. Stanislaus River below New Melones Reservoir, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	59	56	54	52	51	51	51	52	53	54	55	57
20%	56	55	53	51	50	50	50	51	52	53	53	54
30%	53	53	52	51	50	49	50	51	51	52	53	53
40%	53	53	52	51	49	49	50	50	51	51	52	53
50%	52	52	52	50	49	49	49	50	50	51	52	52
60%	52	52	51	50	49	49	49	49	50	50	51	51
70%	51	52	51	50	49	48	48	49	49	50	50	51
80%	51	51	50	49	48	48	48	48	49	50	50	51
90%	50	50	50	48	47	47	47	47	48	48	49	49
Long Term												
Full Simulation Period ^b	53	53	52	50	49	49	49	50	51	51	52	53
Water Year Types ^c												
Wet (32%)	50	50	49	49	48	48	48	48	49	49	50	50
Above Normal (16%)	53	53	52	50	49	48	49	49	50	50	51	52
Below Normal (13%)	53	52	52	51	49	49	49	50	50	51	52	52
Dry (24%)	53	53	52	51	50	50	50	50	51	52	53	54
Critical (15%)	57	54	52	50	50	50	51	53	55	56	57	60

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	57	54	52	51	51	51	52	53	55	60	63
20%	57	55	53	51	50	50	50	51	52	53	54	56
30%	54	54	52	51	50	49	50	51	51	52	53	54
40%	53	53	52	50	49	49	50	50	51	52	52	53
50%	53	53	52	50	49	49	49	50	50	51	52	52
60%	52	52	51	50	49	49	49	49	50	50	51	52
70%	52	52	51	49	48	48	49	49	49	50	51	51
80%	51	51	50	49	47	47	48	48	49	50	50	51
90%	50	50	50	48	46	46	47	47	47	48	49	50
Long Term												
Full Simulation Period ^b	54	53	52	50	49	49	49	50	50	52	53	54
Water Year Types ^c												
Wet (32%)	51	50	49	49	48	48	48	48	49	49	50	50
Above Normal (16%)	54	53	52	50	49	48	48	49	50	50	51	52
Below Normal (13%)	53	52	51	50	49	49	49	50	51	52	53	53
Dry (24%)	54	53	52	51	50	49	50	51	51	53	54	56
Critical (15%)	58	55	52	50	49	50	52	54	53	56	58	61

Alternative 5 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	1.9	0.9	0.3	-0.2	-0.1	0.0	0.2	0.6	0.5	1.8	4.7	5.7
0.2	1.1	0.4	0.1	-0.1	0.0	0.1	0.2	0.3	0.2	0.8	1.4	1.6
0.3	1.0	0.5	-0.1	0.0	-0.1	0.0	0.1	0.2	0.2	0.4	0.5	0.8
0.4	0.3	0.3	0.0	-0.2	0.0	0.0	0.1	0.0	-0.1	0.1	0.2	0.3
0.5	0.1	0.1	0.0	0.0	-0.2	0.0	0.0	0.1	-0.1	0.1	0.1	0.1
0.6	0.1	0.1	-0.1	-0.2	-0.2	-0.1	0.0	0.0	-0.1	0.0	0.0	0.1
0.7	0.2	0.2	0.0	-0.2	-0.3	-0.1	0.2	0.0	-0.1	0.0	0.1	0.1
0.8	0.0	0.1	-0.1	-0.3	-0.7	-0.2	-0.3	-0.3	-0.4	-0.1	0.1	0.0
0.9	0.0	0.1	-0.3	-0.5	-0.6	-0.5	-0.2	-0.1	-0.1	0.0	0.0	0.3
Long Term												
Full Simulation Period ^b	0.6	0.3	0.0	-0.2	-0.3	-0.1	0.0	0.2	-0.2	0.4	0.7	0.7
Water Year Types ^c												
Wet (32%)	0.7	0.2	-0.1	-0.2	-0.2	-0.2	-0.2	-0.1	-0.1	0.0	0.1	0.1
Above Normal (16%)	0.5	0.4	0.1	0.0	-0.1	-0.1	-0.1	0.0	0.1	0.1	0.2	0.3
Below Normal (13%)	0.3	-0.2	-0.3	-0.4	-0.3	-0.2	0.0	0.2	0.3	0.5	0.7	0.9
Dry (24%)	0.7	0.6	0.3	-0.1	-0.1	-0.1	0.0	0.1	0.3	0.8	1.6	1.9
Critical (15%)	0.5	0.6	-0.1	-0.7	-0.7	0.2	0.8	1.1	-2.1	0.7	0.8	0.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-15-4. Stanislaus River below New Melones Reservoir, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	58	56	54	52	51	51	51	52	52	54	55	57
20%	54	54	53	51	50	50	50	51	52	52	53	54
30%	53	53	52	51	50	50	50	50	51	52	52	53
40%	53	53	52	51	49	49	50	50	51	51	52	52
50%	52	52	52	50	49	49	49	50	50	51	52	52
60%	52	52	51	50	49	49	49	49	50	50	51	51
70%	51	52	51	50	49	48	48	49	49	50	50	51
80%	51	51	50	49	48	48	48	48	49	50	50	51
90%	50	50	50	48	47	47	47	47	48	48	49	49
Long Term												
Full Simulation Period ^b	53	53	52	50	49	49	49	50	50	51	52	53
Water Year Types ^c												
Wet (32%)	50	50	49	49	48	48	48	48	49	49	50	50
Above Normal (16%)	53	53	52	50	49	48	49	49	50	50	51	52
Below Normal (13%)	52	52	51	51	49	49	49	50	50	51	52	52
Dry (24%)	53	53	52	51	50	50	50	50	51	52	53	54
Critical (15%)	57	55	53	51	50	50	51	53	53	56	57	58

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	59	56	54	52	51	51	51	52	53	54	55	57
20%	56	55	53	51	50	50	50	51	52	53	53	54
30%	53	53	52	51	50	49	50	51	51	52	53	53
40%	53	53	52	51	49	49	50	50	51	51	52	53
50%	52	52	52	50	49	49	49	50	50	51	52	52
60%	52	52	51	50	49	49	49	49	50	50	51	51
70%	51	52	51	50	49	48	48	49	49	50	50	51
80%	51	51	50	49	48	48	48	48	49	50	50	51
90%	50	50	50	48	47	47	47	47	48	48	49	49
Long Term												
Full Simulation Period ^b	53	53	52	50	49	49	49	50	51	51	52	53
Water Year Types ^c												
Wet (32%)	50	50	49	49	48	48	48	48	49	49	50	50
Above Normal (16%)	53	53	52	50	49	48	49	49	50	50	51	52
Below Normal (13%)	53	52	52	51	49	49	49	50	50	51	52	52
Dry (24%)	53	53	52	51	50	50	50	50	51	52	53	54
Critical (15%)	57	54	52	50	50	50	51	53	55	56	57	60

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.7	0.3	0.0	0.0	-0.3	-0.1	0.0	0.0	0.1	0.1	-0.1	0.9
0.2	1.4	0.4	0.0	0.1	-0.1	-0.1	0.0	0.0	0.0	0.1	0.1	0.9
0.3	0.3	0.1	0.0	0.0	-0.1	-0.1	-0.1	0.0	0.0	0.2	0.1	0.1
0.4	0.4	0.1	-0.1	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.2
0.5	0.3	0.2	0.0	-0.1	-0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.2
0.6	0.2	0.1	0.0	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
0.7	0.2	0.1	0.0	0.0	0.0	0.0	-0.1	0.0	-0.1	0.0	0.0	0.1
0.8	0.1	0.0	0.0	-0.1	-0.2	-0.1	-0.1	-0.1	0.0	0.0	-0.1	0.1
0.9	0.3	0.0	0.0	-0.2	0.0	0.0	0.0	0.0	-0.1	0.0	0.2	-0.1
Long Term												
Full Simulation Period ^b	0.3	0.1	0.0	-0.1	-0.1	0.0	0.0	0.0	0.2	-0.1	0.1	0.4
Water Year Types ^c												
Wet (32%)	0.3	0.2	0.0	-0.1	-0.1	0.1	-0.1	0.0	-0.1	0.0	0.0	0.0
Above Normal (16%)	0.4	0.3	0.1	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.1
Below Normal (13%)	0.6	0.4	0.1	-0.1	-0.1	-0.1	0.0	0.0	0.1	0.1	0.2	0.3
Dry (24%)	0.3	0.3	0.1	0.0	-0.1	0.0	0.0	0.0	0.0	0.1	0.2	0.3
Critical (15%)	0.1	-1.0	-0.3	-0.3	-0.3	-0.2	0.3	-0.2	1.4	-0.6	0.1	2.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-15-5. Stanislaus River below New Melones Reservoir, Monthly Temperature

Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	58	56	54	52	51	51	51	52	52	54	55	57
20%	54	54	53	51	50	50	50	51	52	52	53	54
30%	53	53	52	51	50	50	50	50	51	52	52	53
40%	53	53	52	51	49	49	50	50	51	51	52	52
50%	52	52	52	50	49	49	49	50	50	51	52	52
60%	52	52	51	50	49	49	49	49	50	50	51	51
70%	51	52	51	50	49	48	48	49	49	50	50	51
80%	51	51	50	49	48	48	48	48	49	50	50	51
90%	50	50	50	48	47	47	47	47	48	48	49	49
Long Term												
Full Simulation Period ^b	53	53	52	50	49	49	49	50	50	51	52	53
Water Year Types ^c												
Wet (32%)	50	50	49	49	48	48	48	48	49	49	50	50
Above Normal (16%)	53	53	52	50	49	48	49	49	50	50	51	52
Below Normal (13%)	52	52	51	51	49	49	49	50	50	51	52	52
Dry (24%)	53	53	52	51	50	50	50	50	51	52	53	54
Critical (15%)	57	55	53	51	50	50	51	53	53	56	57	58

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	56	55	53	52	51	51	51	52	52	53	54	55
20%	54	54	53	51	50	50	50	51	52	52	53	53
30%	53	53	52	51	50	50	50	50	51	51	52	53
40%	52	52	52	51	50	49	50	50	51	51	52	52
50%	52	52	51	50	49	49	49	50	50	51	51	51
60%	51	52	51	50	49	49	49	49	50	50	51	51
70%	51	51	51	50	49	49	49	49	49	50	50	51
80%	51	51	51	49	48	48	48	48	49	49	50	50
90%	50	50	50	48	47	47	47	48	48	49	49	49
Long Term												
Full Simulation Period ^b	52	52	52	50	49	49	49	50	50	51	52	52
Water Year Types ^c												
Wet (32%)	49	50	49	49	48	48	48	49	49	49	50	50
Above Normal (16%)	52	52	51	50	49	49	49	49	50	50	51	51
Below Normal (13%)	52	51	51	50	49	49	49	50	50	51	51	52
Dry (24%)	52	52	52	51	50	50	50	50	51	51	52	53
Critical (15%)	56	55	53	51	50	50	51	52	54	56	56	57

Alternative 3 minus Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-2.5	-0.5	-0.4	0.1	-0.3	0.1	0.1	0.0	-0.3	-0.6	-1.5	-1.6
0.2	-0.6	-0.4	-0.2	0.0	0.0	0.1	0.2	-0.1	-0.1	-0.3	-0.3	-0.2
0.3	-0.5	-0.4	-0.2	0.0	0.0	0.1	0.0	-0.1	-0.2	-0.2	-0.4	-0.4
0.4	-0.5	-0.4	-0.2	-0.1	0.0	0.1	0.0	-0.1	-0.3	-0.2	-0.3	-0.4
0.5	-0.4	-0.3	-0.1	0.0	0.1	0.1	0.0	-0.1	-0.3	-0.5	-0.4	-0.4
0.6	-0.4	-0.4	-0.1	0.0	0.0	0.1	0.1	0.0	0.0	-0.1	-0.2	-0.2
0.7	-0.1	-0.2	0.0	0.1	0.1	0.3	0.3	0.1	0.0	-0.1	-0.1	-0.1
0.8	-0.4	-0.4	0.2	0.0	0.2	0.4	0.2	0.0	0.1	-0.3	-0.4	-0.3
0.9	0.1	0.0	0.2	-0.1	0.4	0.3	0.3	0.4	0.4	0.1	0.3	0.1
Long Term												
Full Simulation Period ^b	-0.6	-0.3	-0.1	0.0	0.1	0.1	0.1	-0.2	0.0	-0.3	-0.4	-0.6
Water Year Types ^c												
Wet (32%)	-0.3	-0.2	-0.1	0.0	0.1	0.1	0.1	0.1	0.0	0.0	-0.1	-0.1
Above Normal (16%)	-0.6	-0.5	-0.2	0.0	0.1	0.2	0.2	0.1	0.0	-0.2	-0.3	-0.4
Below Normal (13%)	-0.7	-0.6	-0.3	-0.2	0.0	0.1	0.1	0.0	-0.1	-0.2	-0.3	-0.4
Dry (24%)	-0.3	-0.3	-0.1	-0.2	0.0	0.0	0.1	-0.1	-0.2	-0.4	-0.6	-0.9
Critical (15%)	-1.5	-0.3	0.2	0.5	0.5	0.3	0.0	-1.4	0.3	-0.7	-1.0	-1.5

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-15-6. Stanislaus River below New Melones Reservoir, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	58	56	54	52	51	51	51	52	52	54	55	57
20%	54	54	53	51	50	50	50	51	52	52	53	54
30%	53	53	52	51	50	50	50	50	51	52	52	53
40%	53	53	52	51	49	49	50	50	51	51	52	52
50%	52	52	52	50	49	49	49	50	50	51	52	52
60%	52	52	51	50	49	49	49	49	50	50	51	51
70%	51	52	51	50	49	48	48	49	49	50	50	51
80%	51	51	50	49	48	48	48	48	49	50	50	51
90%	50	50	50	48	47	47	47	47	48	48	49	49
Long Term												
Full Simulation Period ^b	53	53	52	50	49	49	49	50	50	51	52	53
Water Year Types ^c												
Wet (32%)	50	50	49	49	48	48	48	48	49	49	50	50
Above Normal (16%)	53	53	52	50	49	48	49	49	50	50	51	52
Below Normal (13%)	52	52	51	51	49	49	49	50	50	51	52	52
Dry (24%)	53	53	52	51	50	50	50	50	51	52	53	54
Critical (15%)	57	55	53	51	50	50	51	53	53	56	57	58

Alternative 5

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	57	54	52	51	51	51	52	53	55	60	63
20%	57	55	53	51	50	50	50	51	52	53	54	56
30%	54	54	52	51	50	49	50	51	51	52	53	54
40%	53	53	52	50	49	49	50	50	51	52	52	53
50%	53	53	52	50	49	49	49	50	50	51	52	52
60%	52	52	51	50	49	49	49	49	50	50	51	52
70%	52	52	51	49	48	48	49	49	49	50	51	51
80%	51	51	50	49	47	47	48	48	49	50	50	51
90%	50	50	50	48	46	46	47	47	47	48	49	50
Long Term												
Full Simulation Period ^b	54	53	52	50	49	49	49	50	50	52	53	54
Water Year Types ^c												
Wet (32%)	51	50	49	49	48	48	48	48	49	49	50	50
Above Normal (16%)	54	53	52	50	49	48	48	49	50	50	51	52
Below Normal (13%)	53	52	51	50	49	49	49	50	51	52	53	53
Dry (24%)	54	53	52	51	50	49	50	51	51	53	54	56
Critical (15%)	58	55	52	50	49	50	52	54	53	56	58	61

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	2.6	1.2	0.3	-0.2	-0.3	0.0	0.2	0.6	0.6	1.9	4.6	6.6
0.2	2.5	0.8	0.1	0.0	-0.1	0.0	0.3	0.3	0.3	0.9	1.5	2.4
0.3	1.3	0.6	0.0	0.0	-0.2	0.0	0.1	0.2	0.3	0.6	0.6	0.9
0.4	0.7	0.4	0.0	-0.2	-0.1	0.0	0.1	0.0	0.0	0.1	0.2	0.5
0.5	0.4	0.3	0.1	-0.1	-0.3	-0.1	0.0	0.1	0.0	0.2	0.2	0.3
0.6	0.3	0.3	-0.1	-0.3	-0.3	-0.1	0.0	0.1	-0.1	0.1	0.0	0.1
0.7	0.4	0.3	0.0	-0.2	-0.3	-0.2	0.1	0.0	-0.1	0.0	0.1	0.2
0.8	0.1	0.1	-0.1	-0.4	-0.9	-0.3	-0.4	-0.4	-0.3	-0.1	0.0	0.0
0.9	0.3	0.1	-0.3	-0.7	-0.6	-0.5	-0.3	-0.1	-0.2	0.0	0.2	0.2
Long Term												
Full Simulation Period ^b	1.0	0.4	0.0	-0.3	-0.4	-0.1	0.0	0.2	0.0	0.3	0.8	1.2
Water Year Types ^c												
Wet (32%)	1.0	0.4	-0.1	-0.3	-0.3	-0.2	-0.3	-0.2	-0.1	0.0	0.1	0.1
Above Normal (16%)	0.9	0.7	0.2	0.0	-0.1	-0.2	-0.1	0.0	0.1	0.2	0.3	0.4
Below Normal (13%)	0.9	0.2	-0.2	-0.5	-0.3	-0.3	0.0	0.2	0.4	0.7	0.9	1.2
Dry (24%)	1.0	0.8	0.4	-0.1	-0.2	-0.1	0.0	0.1	0.4	0.9	1.8	2.3
Critical (15%)	0.6	-0.4	-0.5	-0.9	-1.0	0.0	1.1	1.0	-0.7	0.1	0.9	2.4

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


B.16. Stanislaus River below Tulloch Temperature

Figure B-16-1. Stanislaus River below Tulloch Reservoir, October

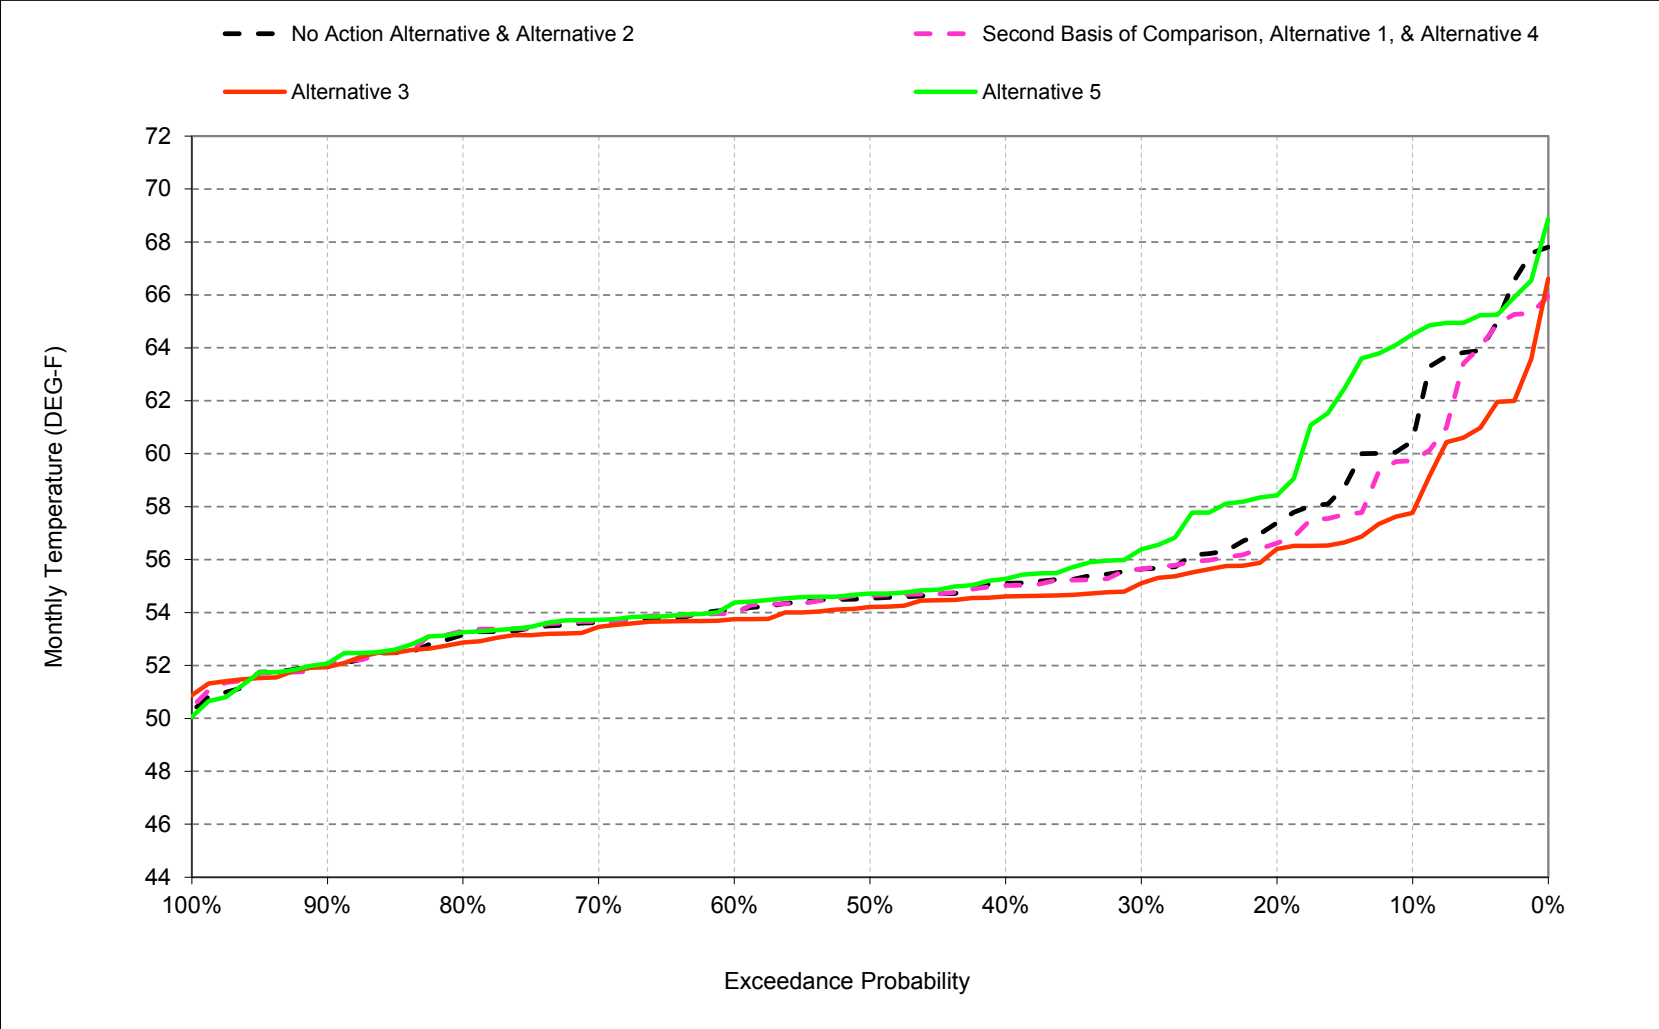


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-16-2. Stanislaus River below Tulloch Reservoir, November

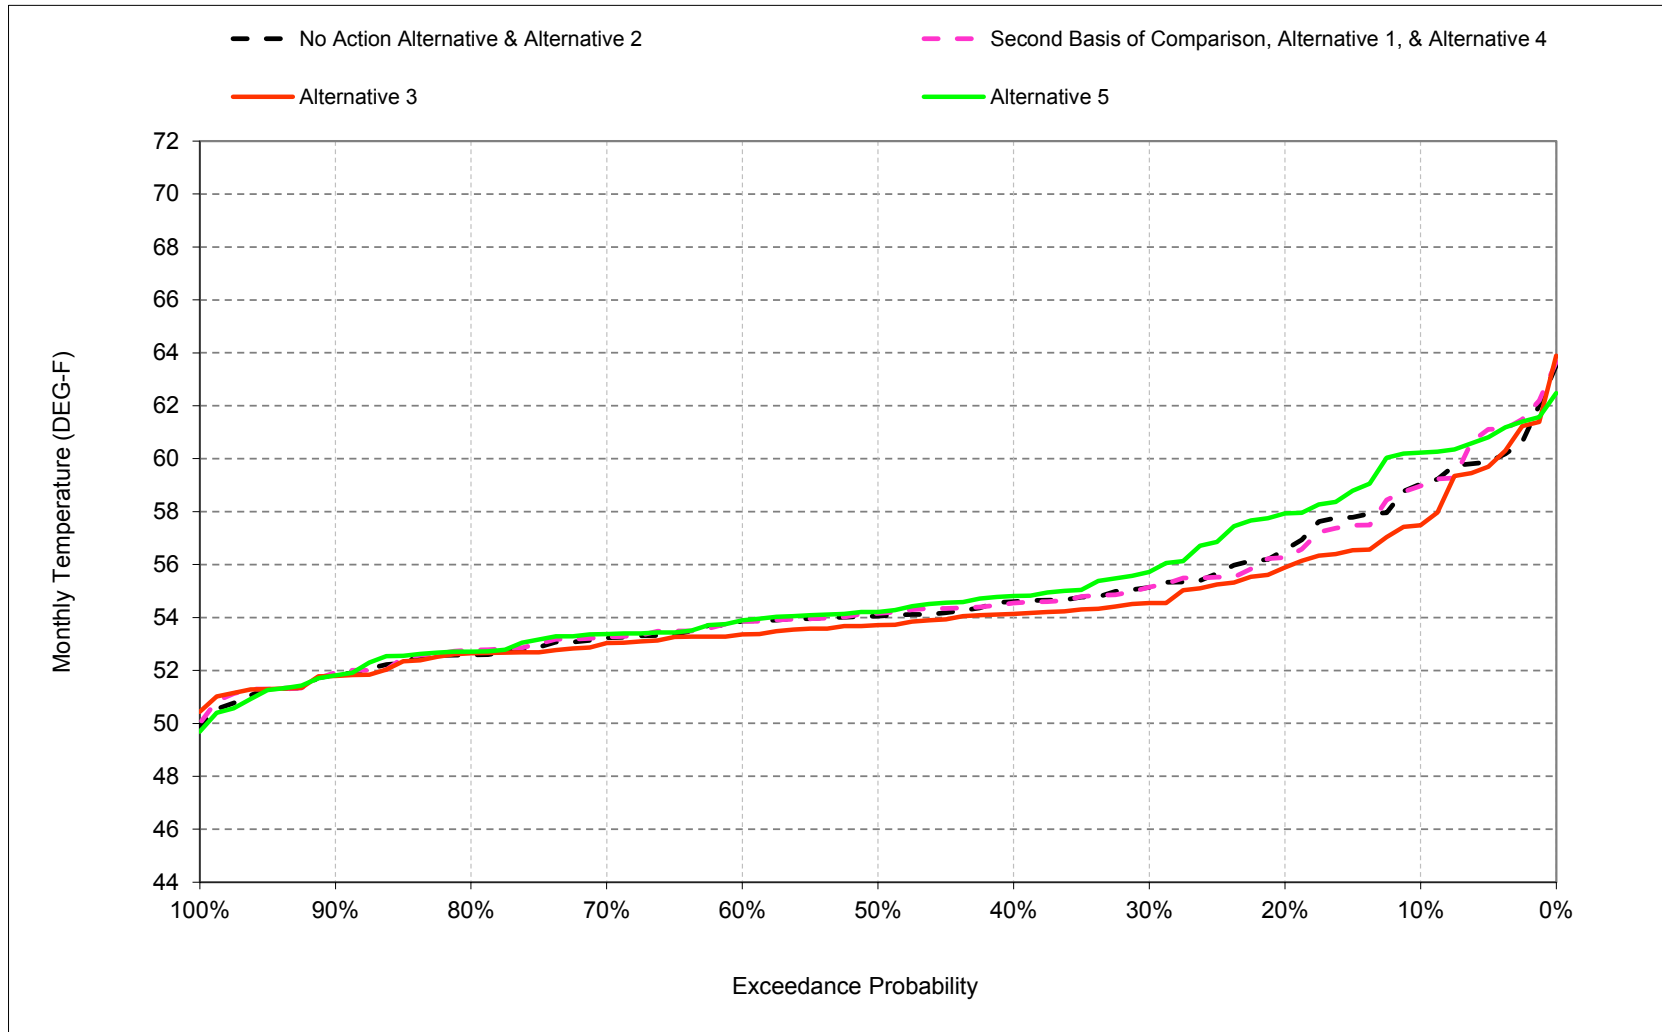


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-16-3. Stanislaus River below Tulloch Reservoir, December

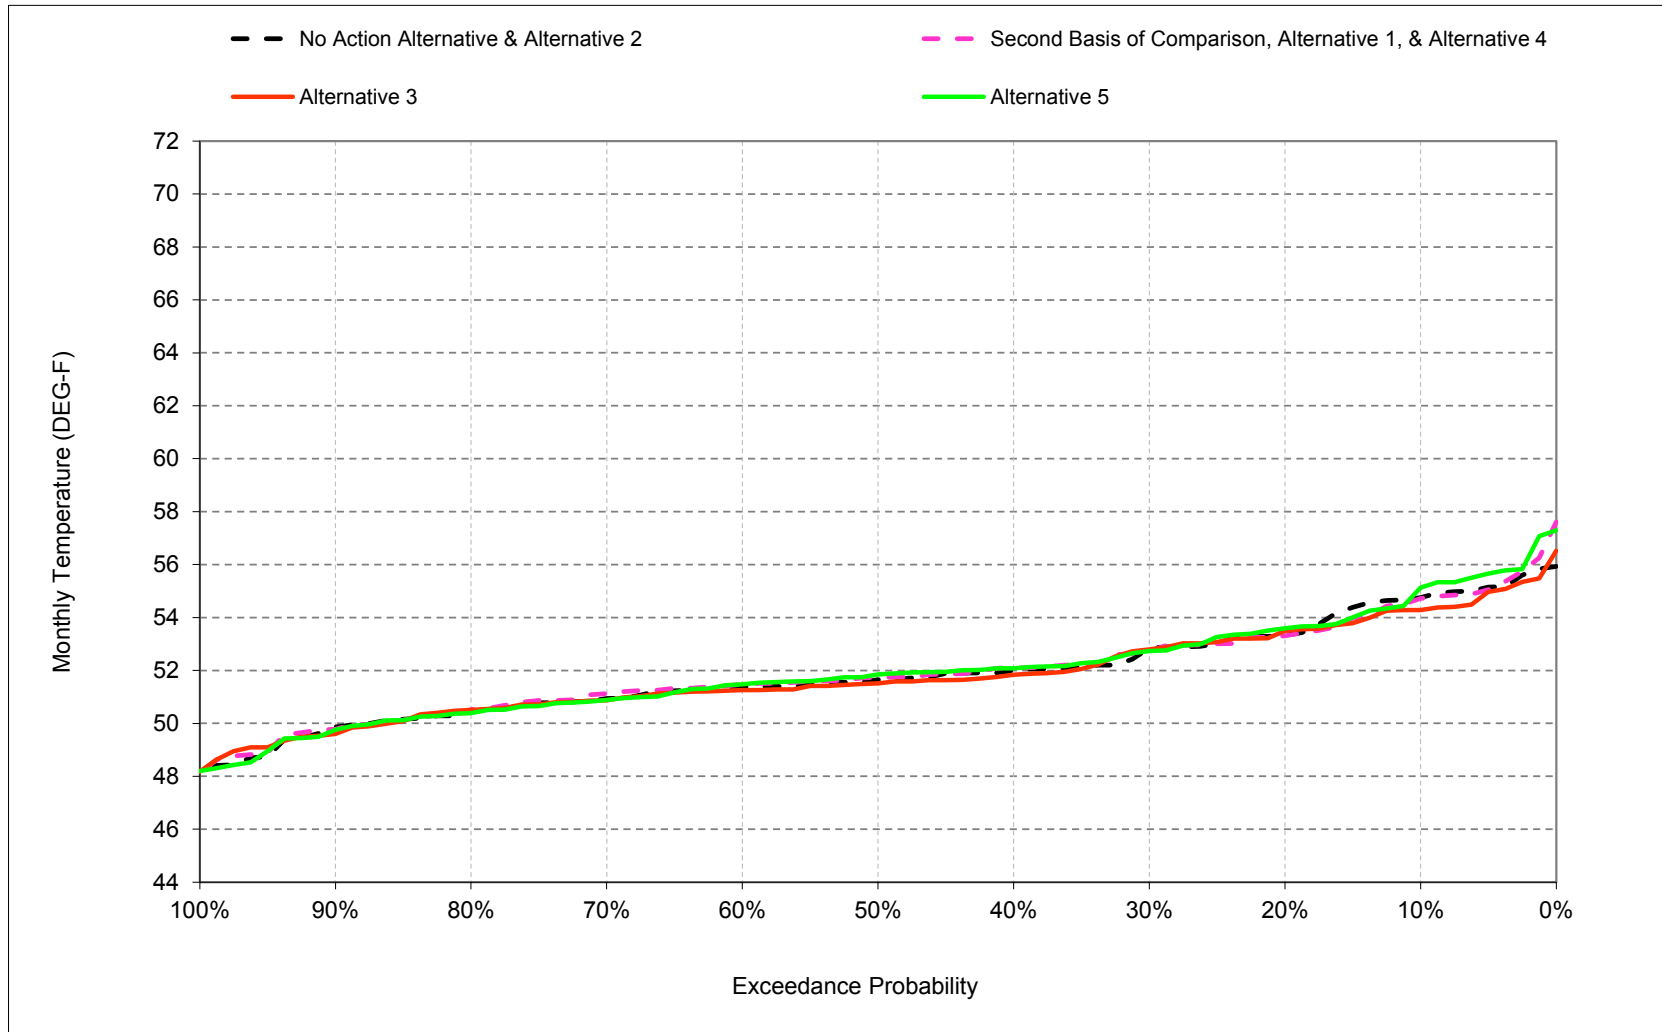


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-16-4. Stanislaus River below Tulloch Reservoir, January

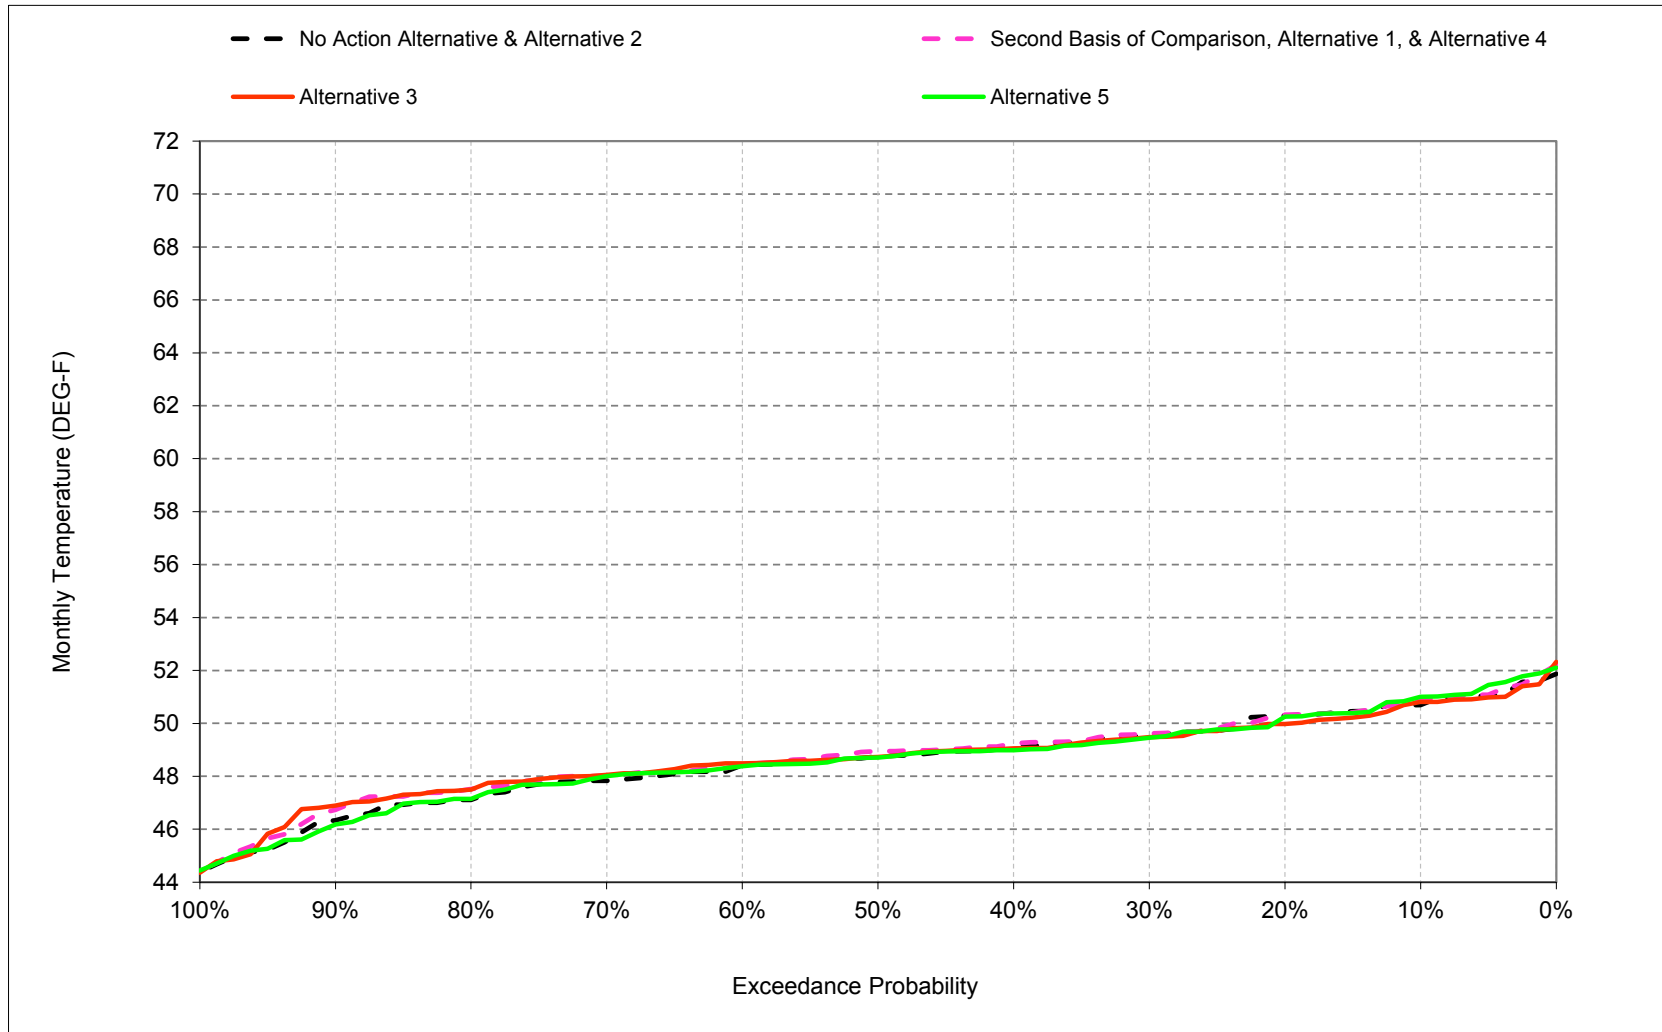


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-16-5. Stanislaus River below Tulloch Reservoir, February

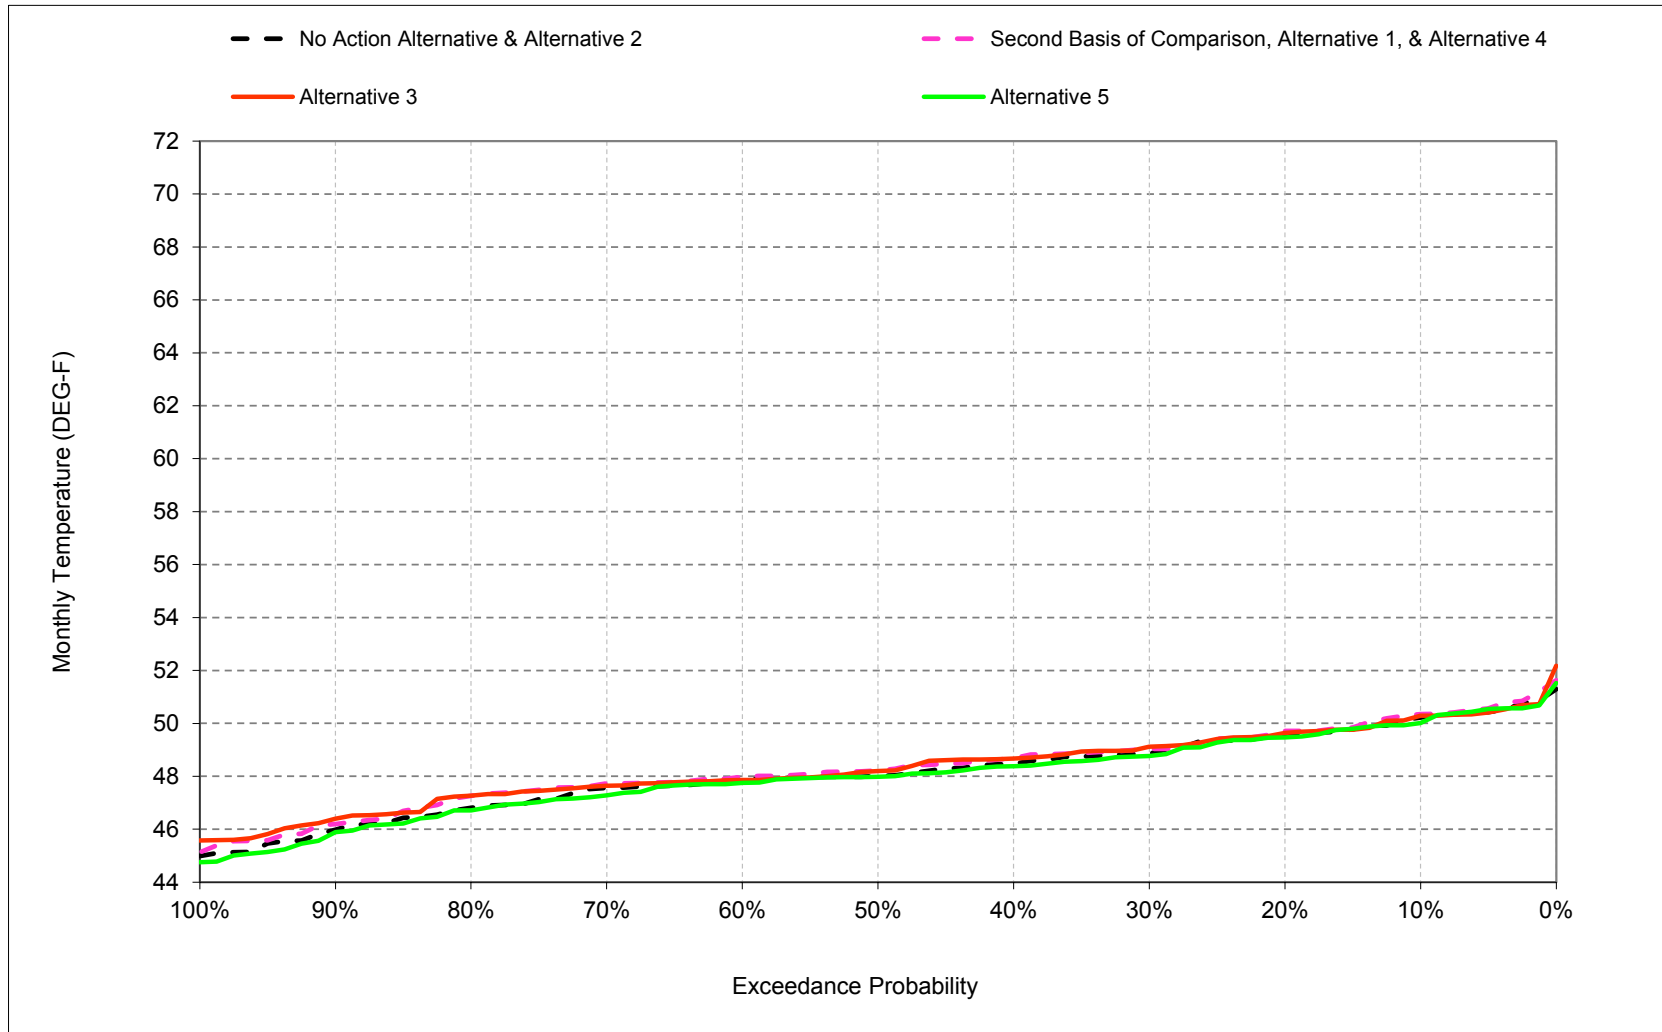


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-16-6. Stanislaus River below Tulloch Reservoir, March

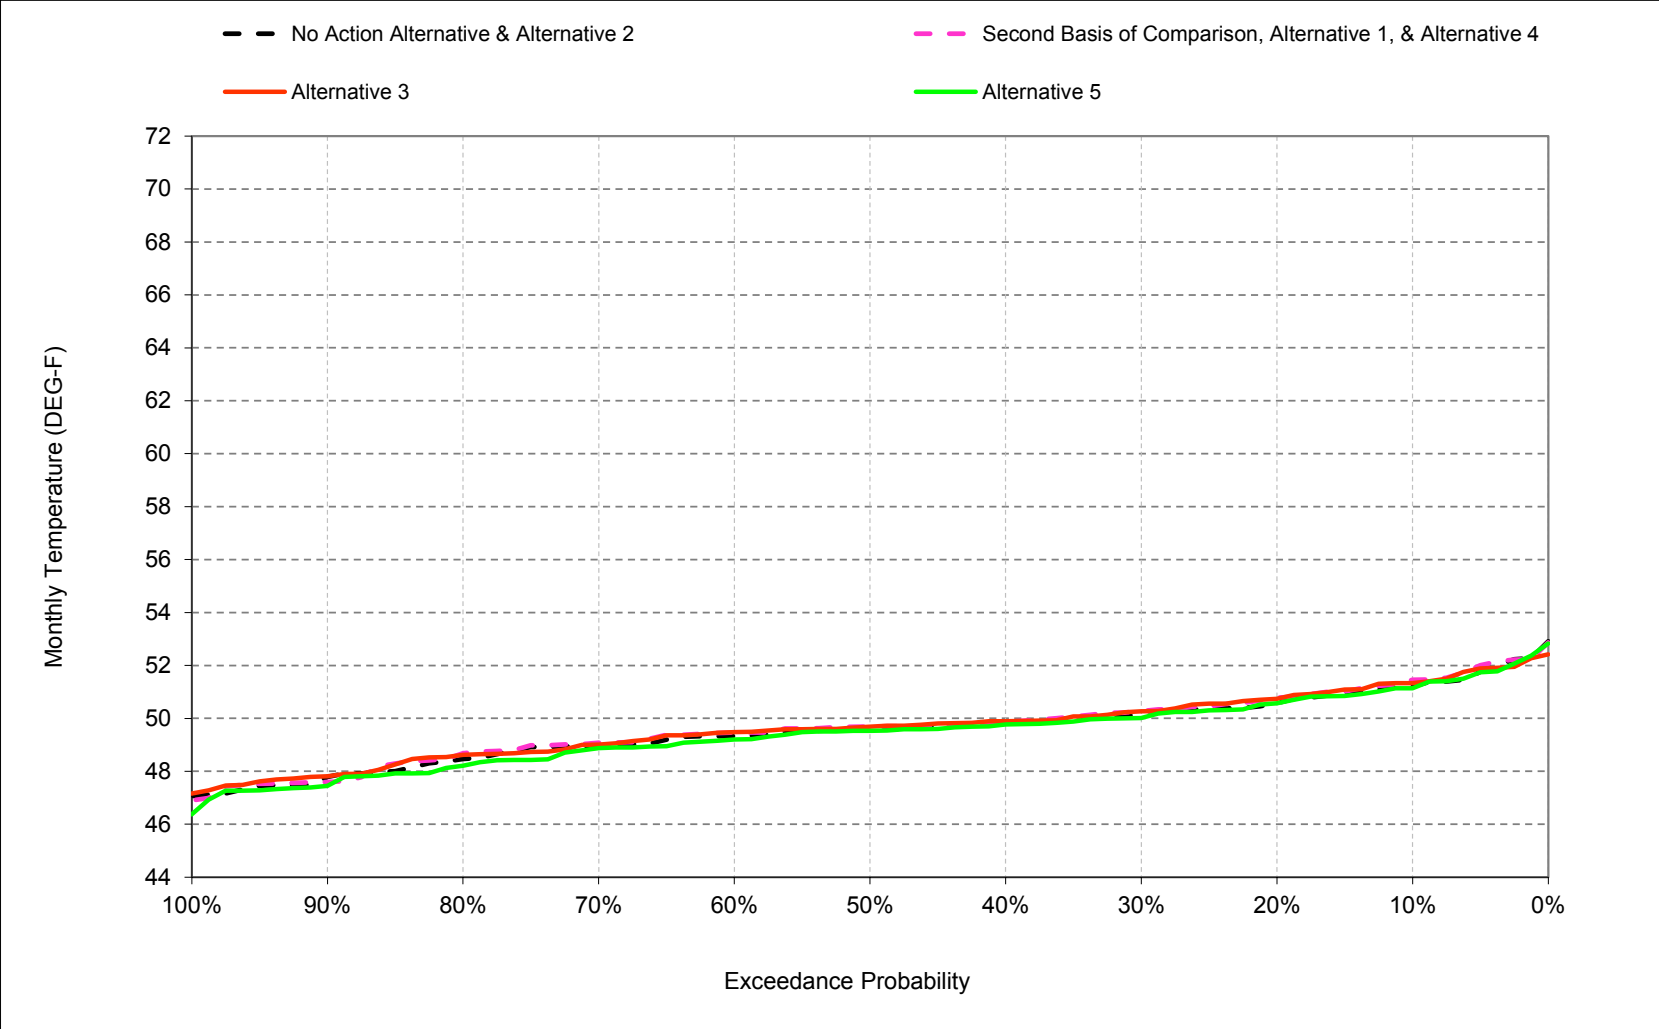


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-16-7. Stanislaus River below Tulloch Reservoir, April

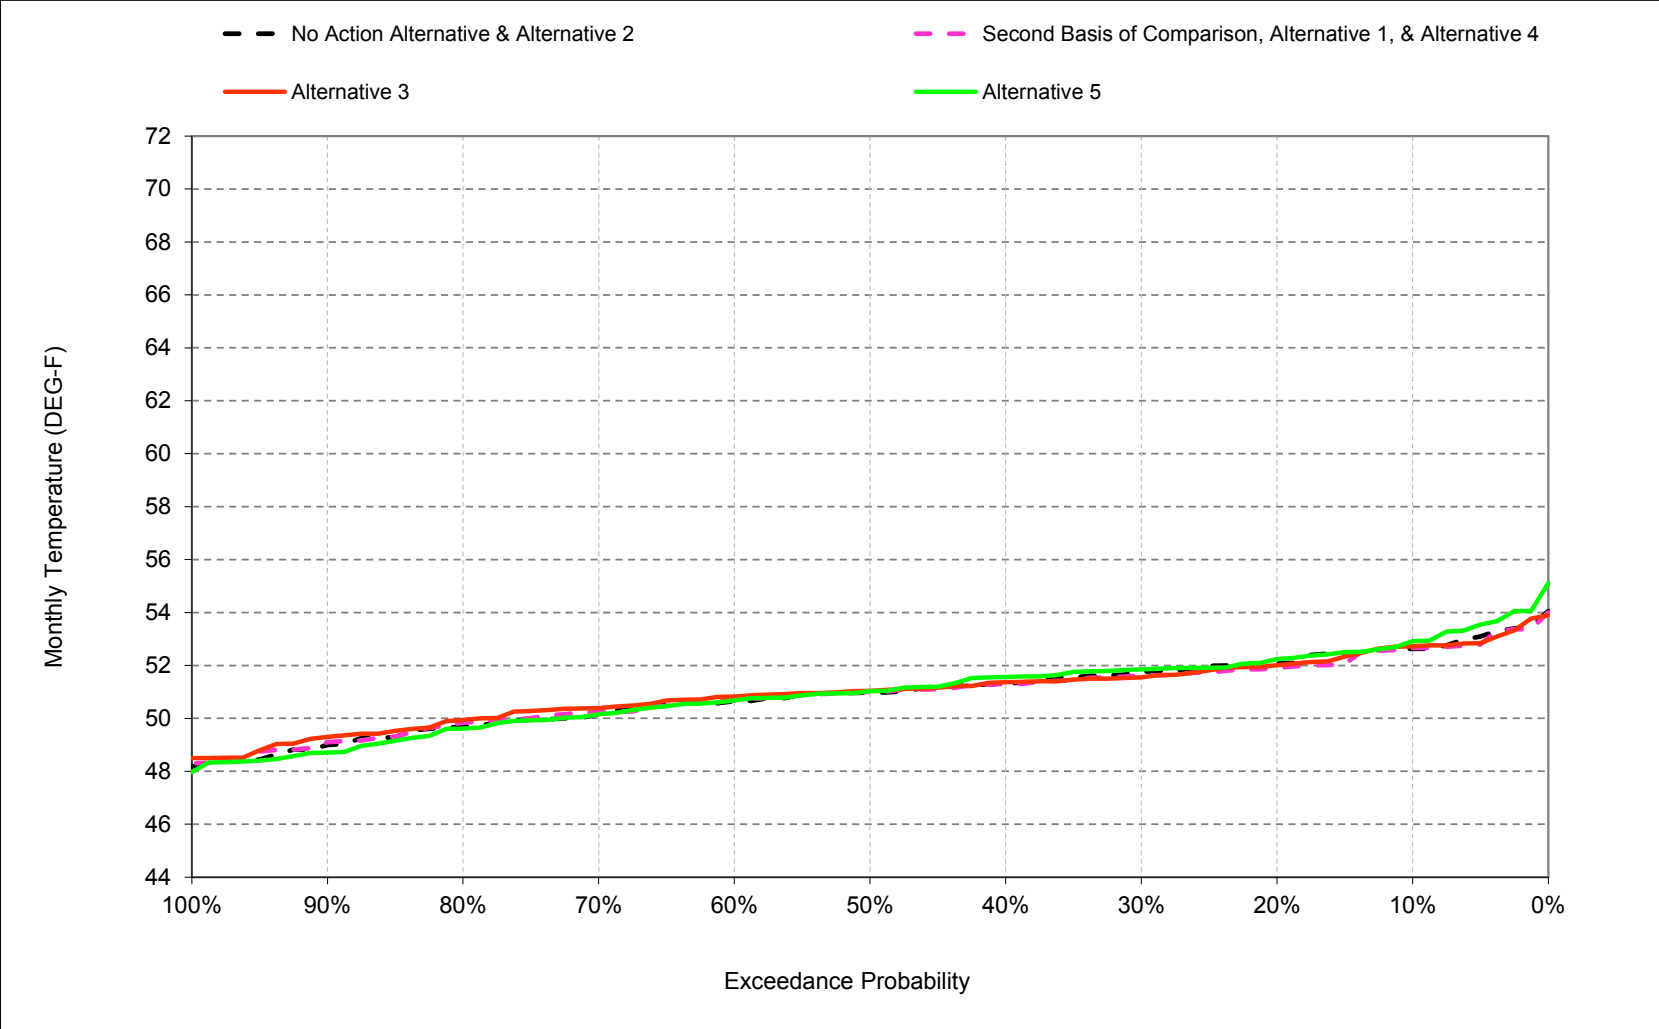


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-16-8. Stanislaus River below Tulloch Reservoir, May

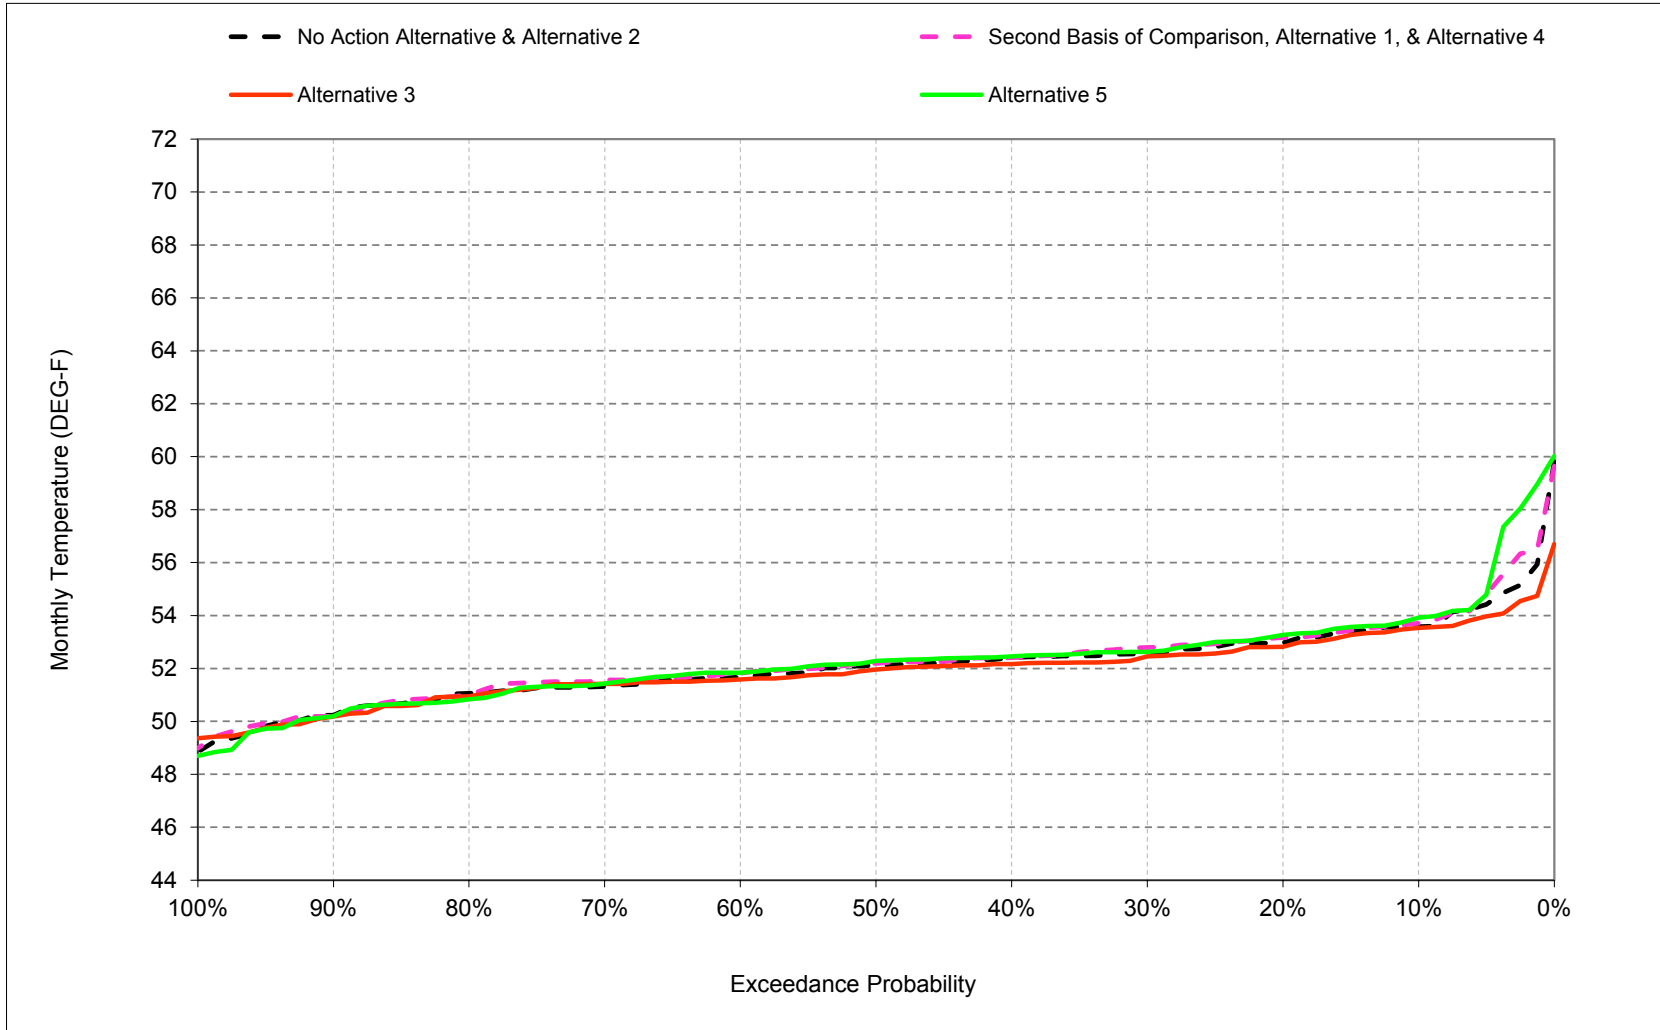


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-16-9. Stanislaus River below Tulloch Reservoir, June

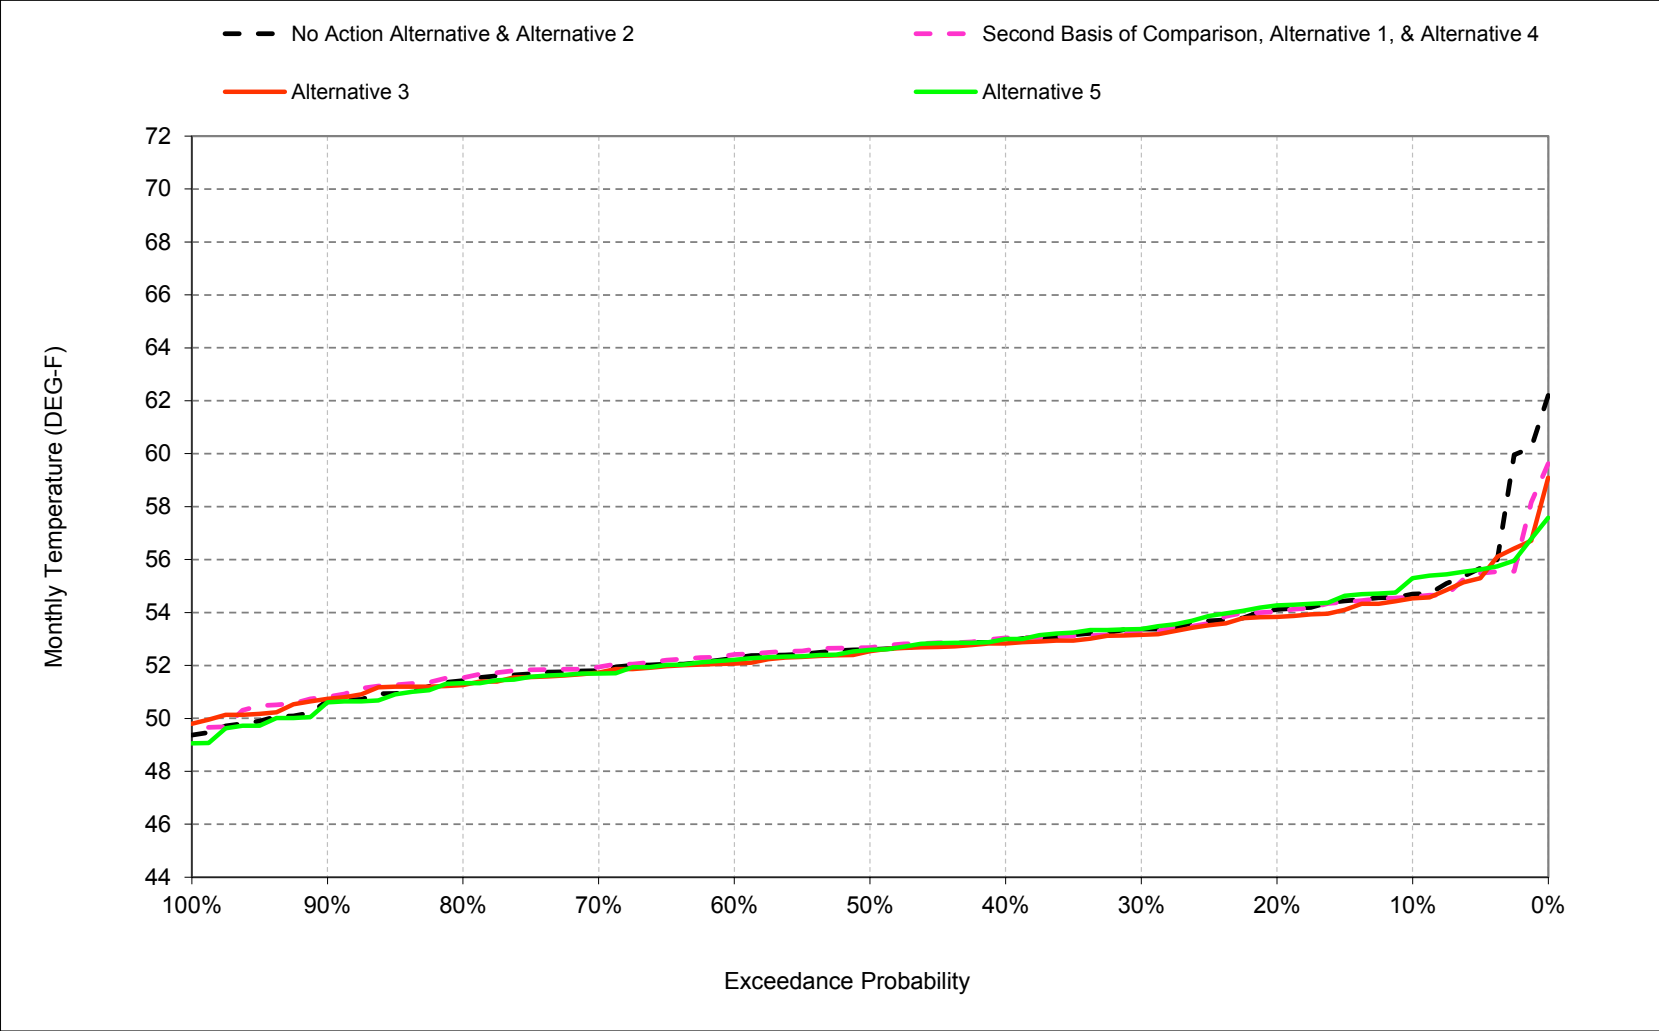


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-16-10. Stanislaus River below Tulloch Reservoir, July

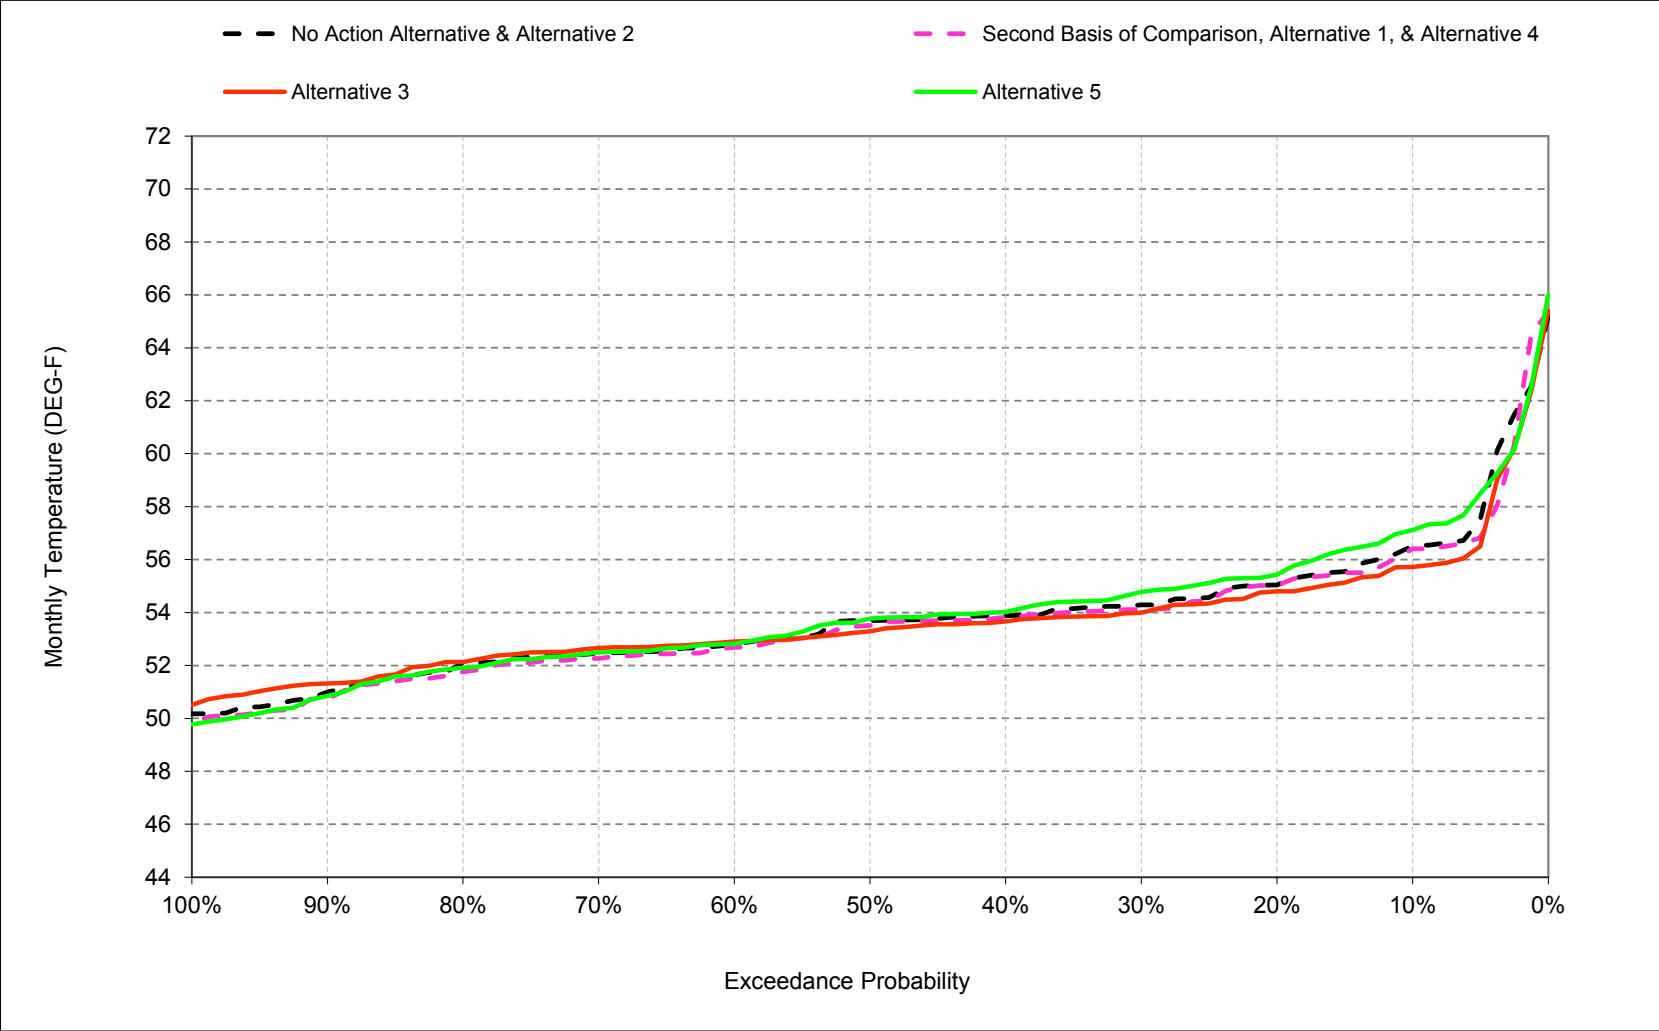


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-16-11. Stanislaus River below Tulloch Reservoir, August

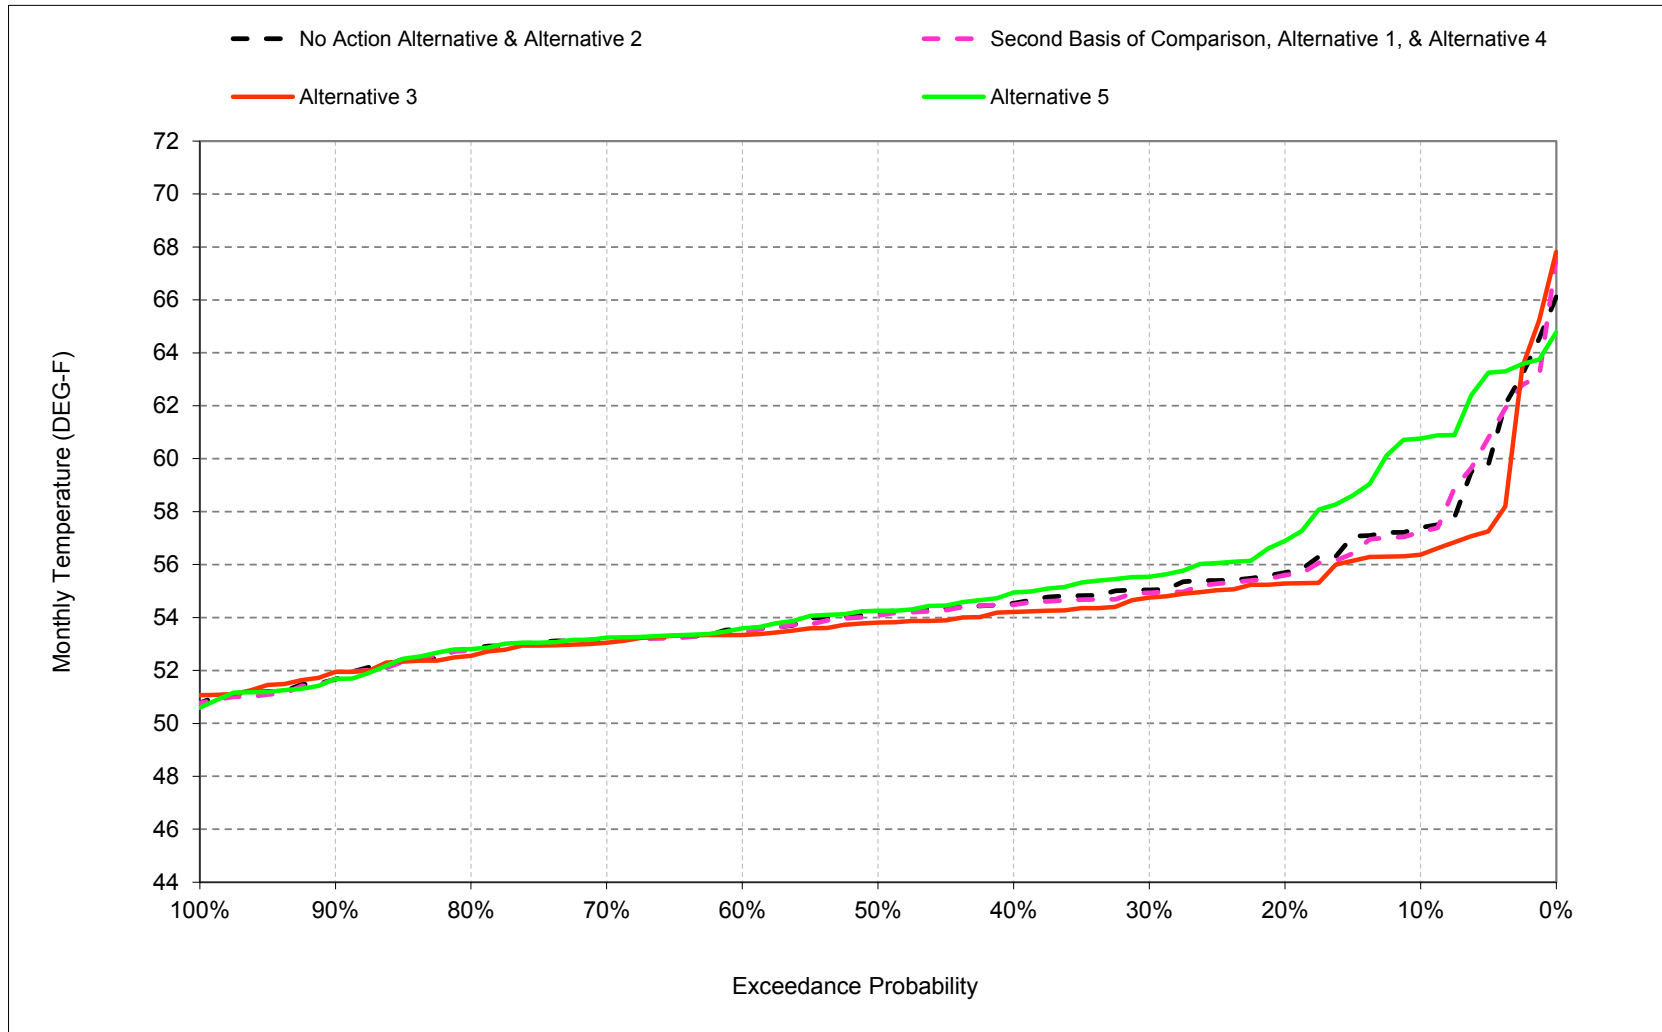

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-16-12. Stanislaus River below Tulloch Reservoir, September

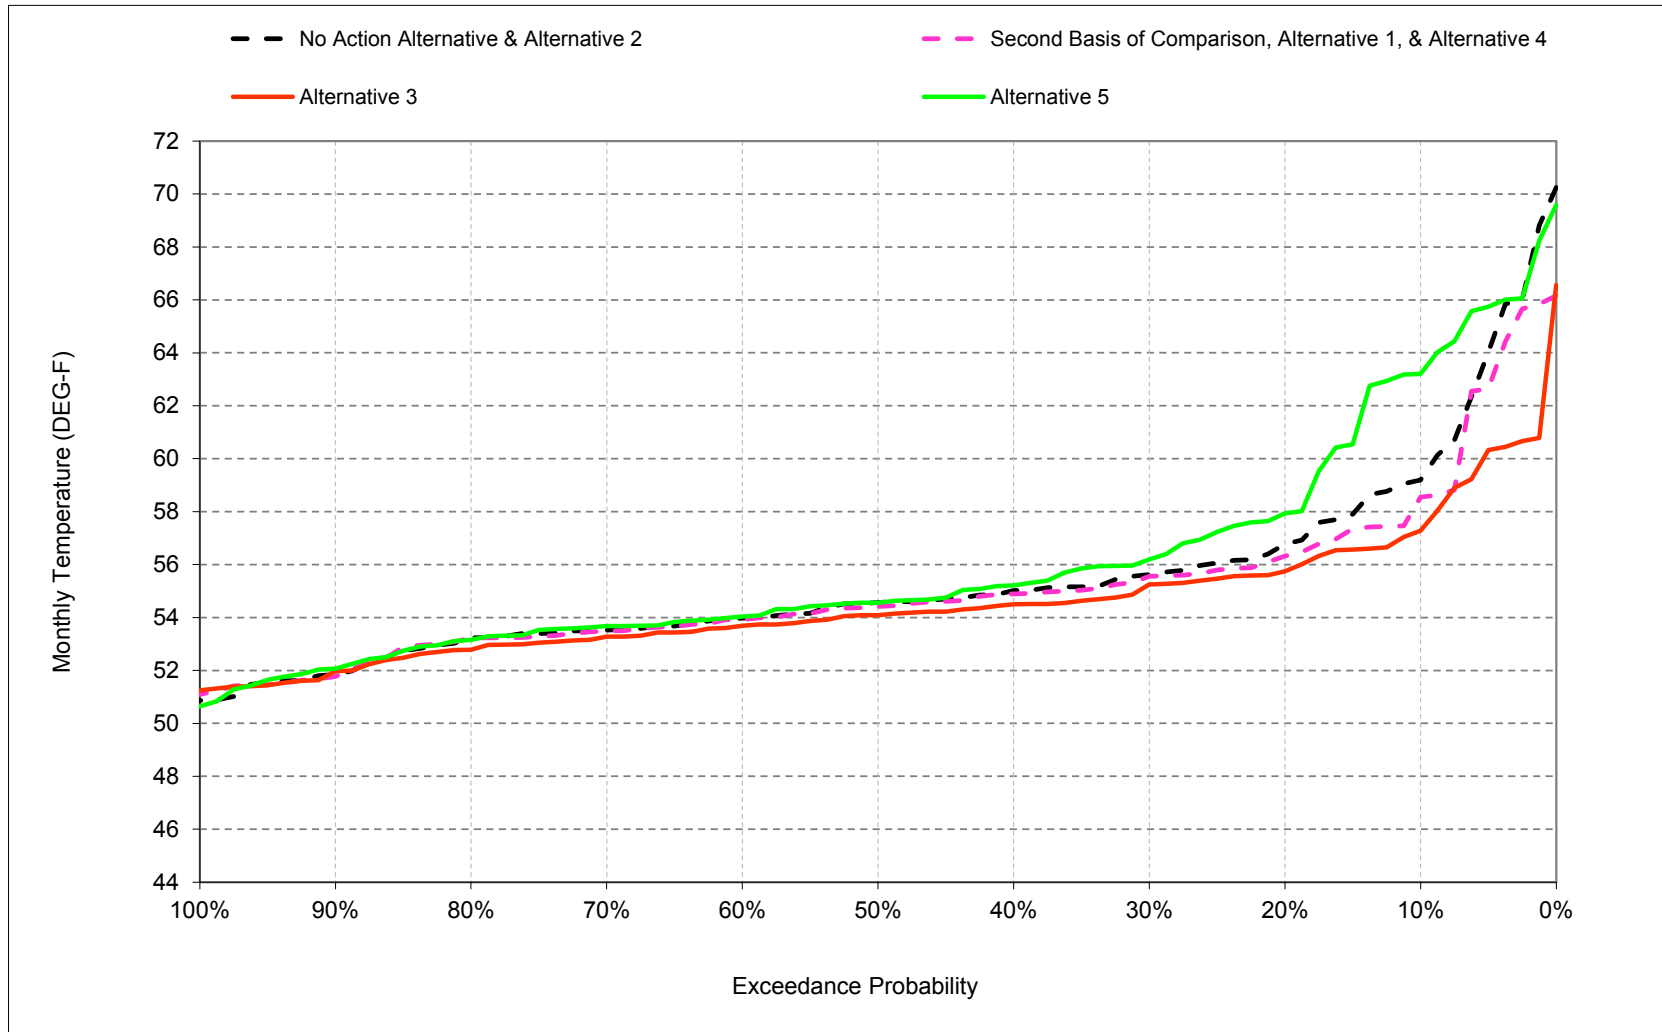

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-16-1. Stanislaus River below Tulloch Reservoir, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	60	59	55	51	50	51	53	54	55	56	57	59
20%	57	57	53	50	49	51	52	53	54	55	56	57
30%	56	55	53	50	49	50	52	53	53	54	55	56
40%	55	55	52	49	48	50	51	52	53	54	55	55
50%	55	54	52	49	48	50	51	52	53	54	54	55
60%	54	54	51	48	48	49	51	52	52	53	54	54
70%	54	53	51	48	48	49	50	51	52	52	53	54
80%	53	53	50	47	47	48	50	51	51	52	53	53
90%	52	52	50	46	46	48	49	50	50	51	52	52
Long Term												
Full Simulation Period ^b	56	55	52	49	48	50	51	52	53	54	55	55
Water Year Types ^c												
Wet (32%)	52	52	49	48	48	49	50	51	51	52	52	53
Above Normal (16%)	56	55	52	49	48	49	51	51	52	53	53	54
Below Normal (13%)	55	54	51	49	48	50	51	52	52	54	54	55
Dry (24%)	55	55	52	49	48	50	51	52	53	54	55	56
Critical (15%)	60	57	54	50	49	51	52	54	56	58	59	62

Alternative 1												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	60	59	55	51	50	51	53	54	55	56	57	58
20%	57	56	53	50	50	51	52	53	54	55	56	56
30%	56	55	53	50	49	50	52	53	53	54	55	55
40%	55	55	52	49	49	50	51	52	53	54	54	55
50%	55	54	52	49	48	50	51	52	53	53	54	54
60%	54	54	51	48	48	49	51	52	52	53	53	54
70%	54	53	51	48	48	49	50	52	52	52	53	53
80%	53	53	51	47	47	49	50	51	52	52	53	53
90%	52	52	50	47	46	48	49	50	51	51	51	52
Long Term												
Full Simulation Period ^b	55	55	52	49	48	50	51	52	53	54	55	55
Water Year Types ^c												
Wet (32%)	52	51	49	48	48	49	50	51	52	52	52	53
Above Normal (16%)	56	55	52	49	48	49	51	52	52	53	53	54
Below Normal (13%)	55	54	51	49	48	50	51	52	52	53	54	55
Dry (24%)	55	55	52	49	49	50	51	53	53	54	55	56
Critical (15%)	59	58	54	50	49	51	52	54	55	58	59	60

Alternative 1 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.7	-0.1	0.0	0.2	0.1	0.2	0.0	0.1	-0.1	-0.1	-0.2	-0.7
0.2	-0.8	-0.3	0.0	0.0	0.2	0.2	-0.2	0.2	-0.1	0.0	-0.1	-0.4
0.3	0.0	0.0	-0.1	0.0	0.2	0.1	-0.1	0.2	-0.1	-0.2	-0.1	-0.1
0.4	-0.1	-0.1	0.1	0.1	0.2	0.0	0.0	0.0	0.1	-0.1	0.0	-0.1
0.5	0.1	0.1	0.1	0.2	0.2	0.1	0.0	0.1	0.1	-0.2	-0.1	-0.2
0.6	-0.1	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	-0.1	-0.1	0.0
0.7	0.0	0.0	0.2	0.2	0.1	0.1	0.2	0.2	0.1	-0.2	0.0	0.0
0.8	0.2	0.2	0.1	0.3	0.5	0.1	0.1	-0.1	0.1	-0.2	0.0	0.0
0.9	0.1	0.1	-0.1	0.3	0.3	0.1	0.1	0.0	0.5	0.0	0.0	-0.1
Long Term												
Full Simulation Period ^b	-0.2	0.1	0.1	0.1	0.2	0.1	0.0	0.1	0.0	-0.2	-0.1	-0.3
Water Year Types ^c												
Wet (32%)	-0.1	-0.1	0.0	0.1	0.2	0.0	0.1	0.0	0.4	-0.2	0.0	0.0
Above Normal (16%)	-0.2	0.1	0.1	0.1	0.2	0.1	-0.1	0.2	0.0	-0.1	-0.1	-0.1
Below Normal (13%)	-0.2	-0.2	-0.1	0.1	0.2	0.1	-0.3	0.3	-0.1	-0.2	-0.2	-0.2
Dry (24%)	-0.2	0.0	0.1	0.2	0.2	0.1	0.0	0.1	-0.1	-0.1	-0.2	-0.3
Critical (15%)	-0.6	0.7	0.3	0.2	0.2	0.2	-0.1	0.2	-0.9	-0.2	0.2	-1.4

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-16-2. Stanislaus River below Tulloch Reservoir, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	60	59	55	51	50	51	53	54	55	56	57	59
20%	57	57	53	50	49	51	52	53	54	55	56	57
30%	56	55	53	50	49	50	52	53	53	54	55	56
40%	55	55	52	49	48	50	51	52	53	54	55	55
50%	55	54	52	49	48	50	51	52	53	54	54	55
60%	54	54	51	48	48	49	51	52	52	53	54	54
70%	54	53	51	48	48	49	50	51	52	52	53	54
80%	53	53	50	47	47	48	50	51	51	52	53	53
90%	52	52	50	46	46	48	49	50	50	51	52	52
Long Term												
Full Simulation Period ^b	56	55	52	49	48	50	51	52	53	54	55	55
Water Year Types ^c												
Wet (32%)	52	52	49	48	48	49	50	51	51	52	52	53
Above Normal (16%)	56	55	52	49	48	49	51	51	52	53	53	54
Below Normal (13%)	55	54	51	49	48	50	51	52	52	54	54	55
Dry (24%)	55	55	52	49	48	50	51	52	53	54	55	56
Critical (15%)	60	57	54	50	49	51	52	54	56	58	59	62

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	58	57	54	51	50	51	53	54	55	56	56	57
20%	56	56	53	50	50	51	52	53	54	55	55	56
30%	55	55	53	49	49	50	52	52	53	54	55	55
40%	55	54	52	49	49	50	51	52	53	54	54	54
50%	54	54	52	49	48	50	51	52	52	53	54	54
60%	54	53	51	48	48	49	51	52	52	53	53	54
70%	53	53	51	48	48	49	50	51	52	53	53	53
80%	53	53	51	47	47	49	50	51	51	52	53	53
90%	52	52	50	47	46	48	49	50	51	51	52	52
Long Term												
Full Simulation Period ^b	55	54	52	49	48	50	51	52	53	54	54	55
Water Year Types ^c												
Wet (32%)	52	51	49	48	48	49	50	51	51	52	52	53
Above Normal (16%)	55	54	52	49	48	49	51	51	52	53	53	54
Below Normal (13%)	54	53	51	49	48	50	51	52	52	53	54	54
Dry (24%)	55	54	52	49	48	50	52	52	53	54	55	55
Critical (15%)	58	57	54	50	49	51	52	54	55	57	59	59

Alternative 3 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-2.7	-1.6	-0.5	0.1	0.1	0.1	0.1	-0.1	-0.2	-0.8	-1.0	-1.9
0.2	-1.0	-0.7	0.2	-0.3	0.1	0.2	-0.1	-0.1	-0.3	-0.2	-0.4	-1.0
0.3	-0.5	-0.6	0.0	-0.1	0.2	0.1	-0.2	-0.1	-0.2	-0.3	-0.3	-0.5
0.4	-0.5	-0.5	-0.2	0.0	0.2	0.1	0.1	-0.2	-0.1	-0.2	-0.3	-0.5
0.5	-0.3	-0.3	-0.1	0.0	0.2	0.1	0.1	-0.2	-0.1	-0.4	-0.4	-0.5
0.6	-0.3	-0.5	-0.1	0.2	0.0	0.1	0.2	-0.1	-0.2	0.1	-0.2	-0.3
0.7	-0.2	-0.2	-0.1	0.2	0.1	0.1	0.3	0.1	-0.1	0.2	-0.1	-0.3
0.8	-0.3	0.1	0.1	0.3	0.5	0.2	0.2	-0.1	-0.2	0.3	-0.3	-0.3
0.9	-0.1	0.0	-0.3	0.5	0.4	0.3	0.4	-0.1	0.4	0.5	0.2	-0.1
Long Term												
Full Simulation Period ^b	-0.8	-0.3	-0.1	0.1	0.2	0.1	0.1	-0.2	-0.2	-0.1	-0.3	-0.8
Water Year Types ^c												
Wet (32%)	-0.4	-0.3	-0.1	0.1	0.4	0.1	0.2	-0.1	0.1	0.3	0.0	-0.2
Above Normal (16%)	-0.8	-0.4	0.0	0.1	0.2	0.1	0.1	0.0	-0.1	0.1	-0.2	-0.4
Below Normal (13%)	-1.0	-0.7	-0.3	0.0	0.1	0.1	-0.2	-0.1	0.0	-0.2	-0.4	-0.5
Dry (24%)	-0.5	-0.4	-0.1	0.0	-0.1	0.0	0.1	-0.1	-0.2	-0.3	-0.6	-0.9
Critical (15%)	-1.9	-0.1	0.1	0.2	0.2	0.3	0.0	-0.8	-1.2	-0.7	-0.6	-2.8

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on an 81-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-16-3. Stanislaus River below Tulloch Reservoir, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	60	59	55	51	50	51	53	54	55	56	57	59
20%	57	57	53	50	49	51	52	53	54	55	56	57
30%	56	55	53	50	49	50	52	53	53	54	55	56
40%	55	55	52	49	48	50	51	52	53	54	55	55
50%	55	54	52	49	48	50	51	52	53	54	54	55
60%	54	54	51	48	48	49	51	52	52	53	54	54
70%	54	53	51	48	48	49	50	51	52	52	53	54
80%	53	53	50	47	47	48	50	51	51	52	53	53
90%	52	52	50	46	46	48	49	50	50	51	52	52
Long Term												
Full Simulation Period ^b	56	55	52	49	48	50	51	52	53	54	55	55
Water Year Types ^c												
Wet (32%)	52	52	49	48	48	49	50	51	51	52	52	53
Above Normal (16%)	56	55	52	49	48	49	51	51	52	53	53	54
Below Normal (13%)	55	54	51	49	48	50	51	52	52	54	54	55
Dry (24%)	55	55	52	49	48	50	51	52	53	54	55	56
Critical (15%)	60	57	54	50	49	51	52	54	56	58	59	62

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	65	60	55	51	50	51	53	54	55	57	61	63
20%	58	58	54	50	49	51	52	53	54	55	57	58
30%	56	56	53	49	49	50	52	53	53	55	56	56
40%	55	55	52	49	48	50	52	52	53	54	55	55
50%	55	54	52	49	48	50	51	52	53	54	54	55
60%	54	54	51	48	48	49	51	52	52	53	54	54
70%	54	53	51	48	47	49	50	51	52	52	53	54
80%	53	53	50	47	47	48	50	51	51	52	53	53
90%	52	52	50	46	46	47	49	50	50	51	51	52
Long Term												
Full Simulation Period ^b	56	55	52	49	48	49	51	52	53	54	55	56
Water Year Types ^c												
Wet (32%)	53	52	49	48	47	49	50	51	51	52	53	53
Above Normal (16%)	56	55	52	49	48	49	51	52	52	53	54	54
Below Normal (13%)	56	54	52	49	48	49	51	52	53	54	55	56
Dry (24%)	56	55	52	49	48	50	51	53	54	55	56	58
Critical (15%)	60	58	54	50	49	50	53	55	55	58	60	62

Alternative 5 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	4.0	1.2	0.4	0.3	-0.2	-0.1	0.3	0.3	0.6	0.6	3.4	4.0
0.2	1.1	1.4	0.3	-0.1	0.0	0.0	0.1	0.3	0.2	0.4	1.2	1.2
0.3	0.8	0.6	-0.1	-0.1	-0.1	-0.2	0.1	0.1	0.0	0.5	0.5	0.5
0.4	0.2	0.2	0.1	-0.1	-0.1	-0.1	0.3	0.1	0.1	0.1	0.3	0.2
0.5	0.2	0.2	0.2	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.1	0.0
0.6	0.3	0.0	0.1	0.1	-0.1	-0.2	0.0	0.2	0.0	0.1	0.0	0.0
0.7	0.1	0.1	-0.1	0.1	-0.3	-0.1	0.0	0.1	-0.1	0.0	0.0	0.1
0.8	0.1	0.1	-0.1	0.0	0.0	-0.2	-0.1	-0.3	-0.1	0.0	0.0	0.1
0.9	0.1	0.0	-0.1	-0.3	-0.2	-0.1	-0.1	-0.1	-0.2	0.0	-0.1	0.2
Long Term												
Full Simulation Period ^b	0.6	0.4	0.1	0.0	-0.1	-0.1	0.0	0.2	-0.2	0.1	0.5	0.7
Water Year Types ^c												
Wet (32%)	0.7	0.3	0.1	0.0	-0.1	-0.1	-0.1	-0.1	-0.1	-0.1	0.0	0.2
Above Normal (16%)	0.4	0.4	0.2	0.1	0.0	-0.1	-0.1	0.2	-0.1	0.1	0.2	0.3
Below Normal (13%)	0.7	0.0	0.1	-0.1	-0.1	-0.1	0.0	0.2	0.2	0.4	0.6	0.8
Dry (24%)	0.7	0.5	0.2	0.1	0.0	-0.1	0.0	0.1	0.2	0.5	1.1	1.7
Critical (15%)	0.5	0.7	-0.2	-0.3	-0.3	-0.2	0.6	0.8	-1.1	-0.2	0.8	0.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-16-4. Stanislaus River below Tulloch Reservoir, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	60	59	55	51	50	51	53	54	55	56	57	58
20%	57	56	53	50	50	51	52	53	54	55	56	56
30%	56	55	53	50	49	50	52	53	53	54	55	55
40%	55	55	52	49	49	50	51	52	53	54	54	55
50%	55	54	52	49	48	50	51	52	53	53	54	54
60%	54	54	51	48	48	49	51	52	52	53	53	54
70%	54	53	51	48	48	49	50	52	52	52	53	53
80%	53	53	51	47	47	49	50	51	52	52	53	53
90%	52	52	50	47	46	48	49	50	51	51	51	52
Long Term												
Full Simulation Period ^b	55	55	52	49	48	50	51	52	53	54	55	55
Water Year Types ^c												
Wet (32%)	52	51	49	48	48	49	50	51	52	52	52	53
Above Normal (16%)	56	55	52	49	48	49	51	52	52	53	53	54
Below Normal (13%)	55	54	51	49	48	50	51	52	52	53	54	55
Dry (24%)	55	55	52	49	49	50	51	53	53	54	55	56
Critical (15%)	59	58	54	50	49	51	52	54	55	58	59	60

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	60	59	55	51	50	51	53	54	55	56	57	59
20%	57	57	53	50	49	51	52	53	54	55	56	57
30%	56	55	53	50	49	50	52	53	53	54	55	56
40%	55	55	52	49	48	50	51	52	53	54	55	55
50%	55	54	52	49	48	50	51	52	53	54	54	55
60%	54	54	51	48	48	49	51	52	52	53	54	54
70%	54	53	51	48	48	49	50	51	52	52	53	54
80%	53	53	50	47	47	48	50	51	51	52	53	53
90%	52	52	50	46	46	48	49	50	50	51	52	52
Long Term												
Full Simulation Period ^b	56	55	52	49	48	50	51	52	53	54	55	55
Water Year Types ^c												
Wet (32%)	52	52	49	48	48	49	50	51	51	52	52	53
Above Normal (16%)	56	55	52	49	48	49	51	51	52	53	53	54
Below Normal (13%)	55	54	51	49	48	50	51	52	52	54	54	55
Dry (24%)	55	55	52	49	48	50	51	52	53	54	55	56
Critical (15%)	60	57	54	50	49	51	52	54	56	58	59	62

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.7	0.1	0.0	-0.2	-0.1	-0.2	0.0	-0.1	0.1	0.1	0.2	0.7
0.2	0.8	0.3	0.0	0.0	-0.2	-0.2	0.2	-0.2	0.1	0.0	0.1	0.4
0.3	0.0	0.0	0.1	0.0	-0.2	-0.1	0.1	-0.2	0.1	0.2	0.1	0.1
0.4	0.1	0.1	-0.1	-0.1	-0.2	0.0	0.0	0.0	-0.1	0.1	0.0	0.1
0.5	-0.1	-0.1	-0.1	-0.2	-0.2	-0.1	0.0	-0.1	-0.1	0.2	0.1	0.2
0.6	0.1	0.0	-0.1	-0.1	-0.1	-0.1	-0.1	-0.1	-0.1	0.1	0.1	0.0
0.7	0.0	0.0	-0.2	-0.2	-0.1	-0.1	-0.2	-0.2	-0.1	0.2	0.0	0.0
0.8	-0.2	-0.2	-0.1	-0.3	-0.5	-0.1	-0.1	0.1	-0.1	0.2	0.0	0.0
0.9	-0.1	-0.1	0.1	-0.3	-0.3	-0.1	-0.1	0.0	-0.5	0.0	0.0	0.1
Long Term												
Full Simulation Period ^b	0.2	-0.1	-0.1	-0.1	-0.2	-0.1	0.0	-0.1	0.0	0.2	0.1	0.3
Water Year Types ^c												
Wet (32%)	0.1	0.1	0.0	-0.1	-0.2	0.0	-0.1	0.0	-0.4	0.2	0.0	0.0
Above Normal (16%)	0.2	-0.1	-0.1	-0.1	-0.2	-0.1	0.1	-0.2	0.0	0.1	0.1	0.1
Below Normal (13%)	0.2	0.2	0.1	-0.1	-0.2	-0.1	0.3	-0.3	0.1	0.2	0.2	0.2
Dry (24%)	0.2	0.0	-0.1	-0.2	-0.2	-0.1	0.0	-0.1	0.1	0.1	0.2	0.3
Critical (15%)	0.6	-0.7	-0.3	-0.2	-0.2	-0.2	0.1	-0.2	0.9	0.2	-0.2	1.4

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-16-5. Stanislaus River below Tulloch Reservoir, Monthly Temperature

Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	60	59	55	51	50	51	53	54	55	56	57	58
20%	57	56	53	50	50	51	52	53	54	55	56	56
30%	56	55	53	50	49	50	52	53	53	54	55	55
40%	55	55	52	49	49	50	51	52	53	54	54	55
50%	55	54	52	49	48	50	51	52	53	53	54	54
60%	54	54	51	48	48	49	51	52	52	53	53	54
70%	54	53	51	48	48	49	50	52	52	52	53	53
80%	53	53	51	47	47	49	50	51	52	52	53	53
90%	52	52	50	47	46	48	49	50	51	51	51	52
Long Term												
Full Simulation Period ^b	55	55	52	49	48	50	51	52	53	54	55	55
Water Year Types^c												
Wet (32%)	52	51	49	48	48	49	50	51	52	52	52	53
Above Normal (16%)	56	55	52	49	48	49	51	52	52	53	53	54
Below Normal (13%)	55	54	51	49	48	50	51	52	52	53	54	55
Dry (24%)	55	55	52	49	49	50	51	53	53	54	55	56
Critical (15%)	59	58	54	50	49	51	52	54	55	58	59	60

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	58	57	54	51	50	51	53	54	55	56	56	57
20%	56	56	53	50	50	51	52	53	54	55	55	56
30%	55	55	53	49	49	50	52	52	53	54	55	55
40%	55	54	52	49	49	50	51	52	53	54	54	54
50%	54	54	52	49	48	50	51	52	52	53	54	54
60%	54	53	51	48	48	49	51	52	52	53	53	54
70%	53	53	51	48	48	49	50	51	52	53	53	53
80%	53	53	51	47	47	49	50	51	51	52	53	53
90%	52	52	50	47	46	48	49	50	51	51	52	52
Long Term												
Full Simulation Period ^b	55	54	52	49	48	50	51	52	53	54	54	55
Water Year Types^c												
Wet (32%)	52	51	49	48	48	49	50	51	51	52	52	53
Above Normal (16%)	55	54	52	49	48	49	51	51	52	53	53	54
Below Normal (13%)	54	53	51	49	48	50	51	52	52	53	54	54
Dry (24%)	55	54	52	49	48	50	52	52	53	54	55	55
Critical (15%)	58	57	54	50	49	51	52	54	55	57	59	59

Alternative 3 minus Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
0.1	-2.0	-1.5	-0.4	-0.1	-0.1	-0.1	0.1	-0.2	-0.1	-0.7	-0.8	-1.2
0.2	-0.2	-0.4	0.2	-0.3	-0.1	0.0	0.1	-0.3	-0.2	-0.2	-0.3	-0.6
0.3	-0.5	-0.6	0.1	-0.1	0.1	0.0	-0.1	-0.4	-0.1	-0.1	-0.2	-0.4
0.4	-0.4	-0.4	-0.3	-0.2	0.0	0.0	0.1	-0.2	-0.2	-0.2	-0.3	-0.4
0.5	-0.4	-0.4	-0.2	-0.2	0.0	0.0	0.0	-0.3	-0.2	-0.2	-0.3	-0.3
0.6	-0.2	-0.5	-0.2	0.1	-0.1	0.0	0.1	-0.2	-0.3	0.2	-0.1	-0.3
0.7	-0.2	-0.2	-0.3	0.0	0.0	0.0	0.2	-0.1	-0.2	0.4	-0.1	-0.3
0.8	-0.4	-0.1	0.0	0.0	0.1	0.0	0.2	0.0	-0.3	0.5	-0.2	-0.3
0.9	-0.1	-0.1	-0.2	0.2	0.1	0.2	0.3	-0.1	-0.1	0.6	0.3	0.0
Long Term												
Full Simulation Period ^b	-0.5	-0.4	-0.1	-0.1	0.0	0.0	0.1	-0.3	-0.2	0.1	-0.3	-0.5
Water Year Types^c												
Wet (32%)	-0.3	-0.2	-0.1	0.0	0.3	0.0	0.1	-0.2	-0.3	0.5	0.0	-0.2
Above Normal (16%)	-0.5	-0.4	-0.2	0.0	0.0	0.0	0.2	-0.2	-0.1	0.1	-0.1	-0.3
Below Normal (13%)	-0.7	-0.5	-0.2	-0.1	-0.1	-0.1	0.1	-0.3	0.0	-0.1	-0.2	-0.3
Dry (24%)	-0.3	-0.3	-0.1	-0.1	-0.3	-0.1	0.1	-0.2	-0.1	-0.2	-0.5	-0.7
Critical (15%)	-1.3	-0.8	-0.2	-0.1	-0.1	0.1	0.1	-0.9	-0.2	-0.5	-0.8	-1.5

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-16-6. Stanislaus River below Tulloch Reservoir, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	60	59	55	51	50	51	53	54	55	56	57	58
20%	57	56	53	50	50	51	52	53	54	55	56	56
30%	56	55	53	50	49	50	52	53	53	54	55	55
40%	55	55	52	49	49	50	51	52	53	54	54	55
50%	55	54	52	49	48	50	51	52	53	53	54	54
60%	54	54	51	48	48	49	51	52	52	53	53	54
70%	54	53	51	48	48	49	50	52	52	52	53	53
80%	53	53	51	47	47	49	50	51	52	52	53	53
90%	52	52	50	47	46	48	49	50	51	51	51	52
Long Term												
Full Simulation Period ^b	55	55	52	49	48	50	51	52	53	54	55	55
Water Year Types ^c												
Wet (32%)	52	51	49	48	48	49	50	51	52	52	52	53
Above Normal (16%)	56	55	52	49	48	49	51	52	52	53	53	54
Below Normal (13%)	55	54	51	49	48	50	51	52	52	53	54	55
Dry (24%)	55	55	52	49	49	50	51	53	53	54	55	56
Critical (15%)	59	58	54	50	49	51	52	54	55	58	59	60

Alternative 5

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	65	60	55	51	50	51	53	54	55	57	61	63
20%	58	58	54	50	49	51	52	53	54	55	57	58
30%	56	56	53	49	49	50	52	53	53	55	56	56
40%	55	55	52	49	48	50	52	52	53	54	55	55
50%	55	54	52	49	48	50	51	52	53	54	54	55
60%	54	54	51	48	48	49	51	52	52	53	54	54
70%	54	53	51	48	47	49	50	51	52	52	53	54
80%	53	53	50	47	47	48	50	51	51	52	53	53
90%	52	52	50	46	46	47	49	50	50	51	51	52
Long Term												
Full Simulation Period ^b	56	55	52	49	48	49	51	52	53	54	55	56
Water Year Types ^c												
Wet (32%)	53	52	49	48	47	49	50	51	51	52	53	53
Above Normal (16%)	56	55	52	49	48	49	51	52	52	53	54	54
Below Normal (13%)	56	54	52	49	48	49	51	52	53	54	55	56
Dry (24%)	56	55	52	49	48	50	51	53	54	55	56	58
Critical (15%)	60	58	54	50	49	50	53	55	55	58	60	62

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	4.8	1.3	0.4	0.1	-0.3	-0.3	0.2	0.2	0.7	0.7	3.5	4.8
0.2	1.8	1.7	0.3	-0.1	-0.2	-0.2	0.3	0.1	0.2	0.4	1.3	1.6
0.3	0.8	0.6	0.0	-0.2	-0.3	-0.2	0.2	-0.2	0.1	0.6	0.6	0.6
0.4	0.3	0.3	0.0	-0.2	-0.3	-0.1	0.3	0.0	-0.1	0.2	0.4	0.3
0.5	0.1	0.1	0.1	-0.2	-0.2	-0.2	0.0	0.0	-0.1	0.2	0.2	0.2
0.6	0.4	0.0	0.0	0.0	-0.2	-0.3	0.0	0.0	-0.2	0.2	0.1	0.1
0.7	0.1	0.1	-0.2	-0.1	-0.4	-0.2	-0.1	-0.1	-0.2	0.2	0.1	0.2
0.8	-0.1	-0.1	-0.1	-0.3	-0.5	-0.4	-0.1	-0.2	-0.2	0.2	0.1	0.0
0.9	0.0	-0.1	0.0	-0.7	-0.6	-0.2	-0.2	-0.1	-0.6	0.0	0.0	0.3
Long Term												
Full Simulation Period ^b	0.9	0.3	0.0	-0.1	-0.3	-0.2	0.1	0.0	-0.1	0.3	0.6	1.0
Water Year Types ^c												
Wet (32%)	0.9	0.4	0.1	-0.1	-0.2	-0.1	-0.2	-0.1	-0.5	0.2	0.1	0.1
Above Normal (16%)	0.7	0.4	0.1	-0.1	-0.2	-0.2	0.0	0.0	-0.1	0.2	0.3	0.4
Below Normal (13%)	0.9	0.2	0.1	-0.2	-0.3	-0.2	0.2	-0.1	0.3	0.6	0.8	1.0
Dry (24%)	0.8	0.5	0.2	-0.1	-0.2	-0.2	0.0	0.0	0.2	0.6	1.3	1.9
Critical (15%)	1.1	0.0	-0.5	-0.5	-0.6	-0.4	0.7	0.7	-0.2	0.0	0.6	1.7

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


B.17. Stanislaus River below Goodwin Temperature

Figure B-17-1. Stanislaus River below Goodwin Dam, October

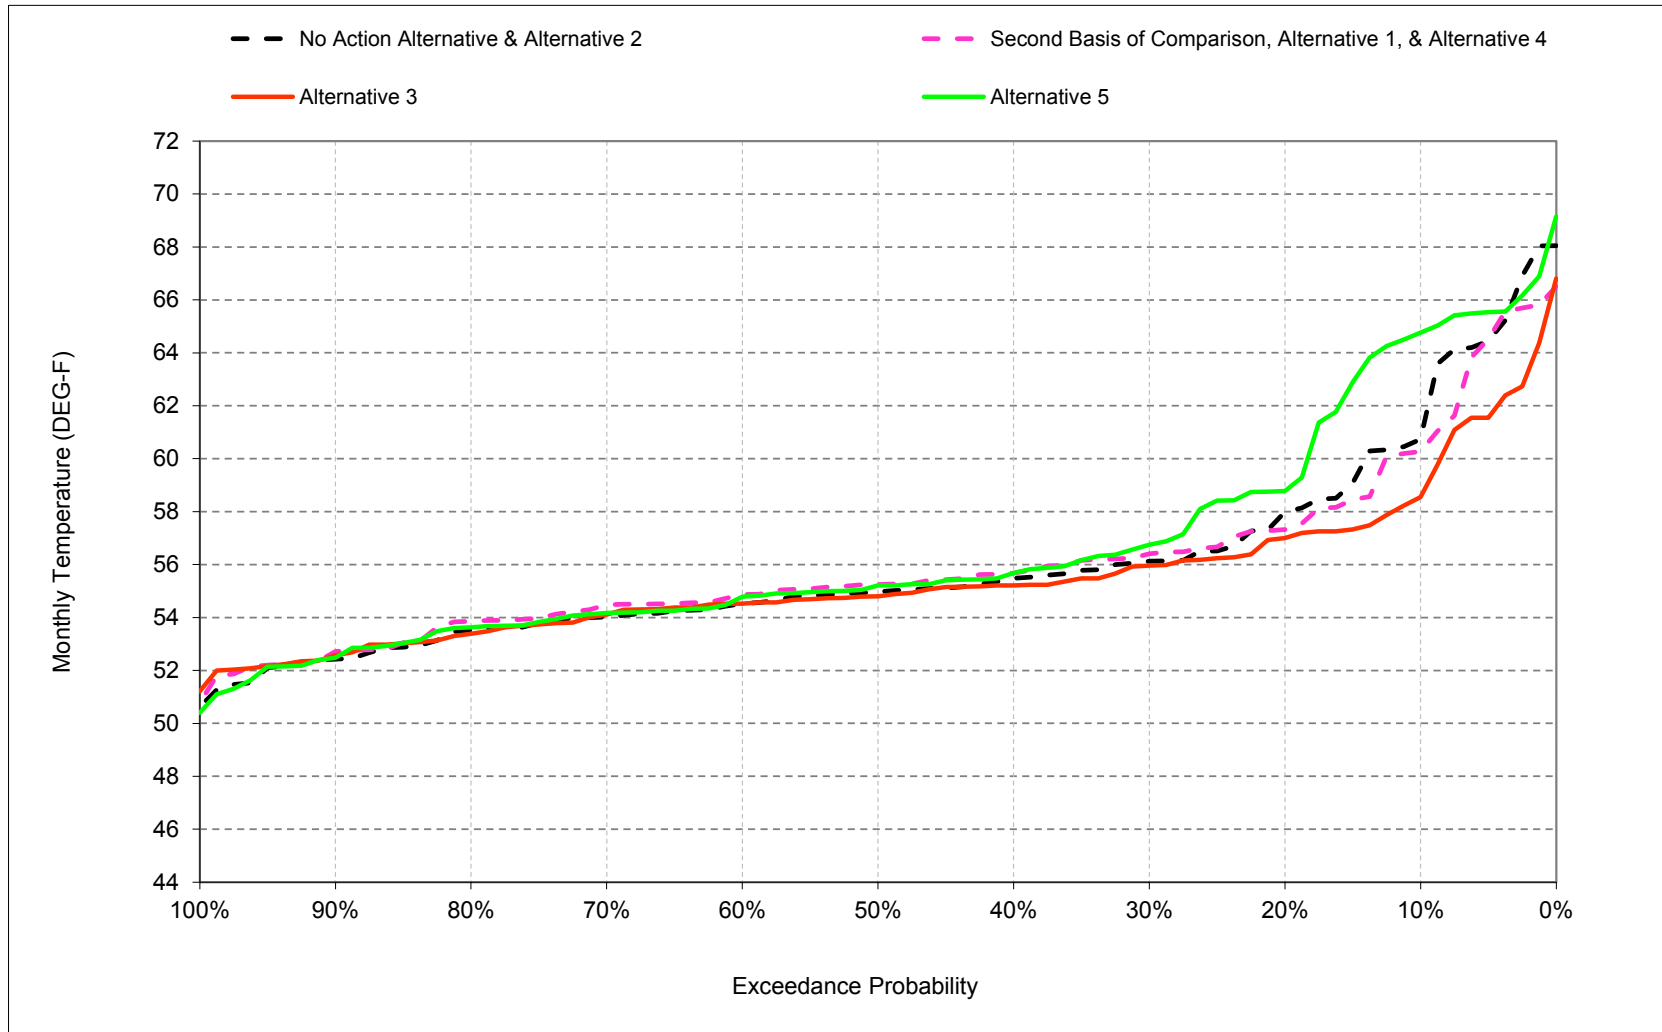


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-17-2. Stanislaus River below Goodwin Dam, November

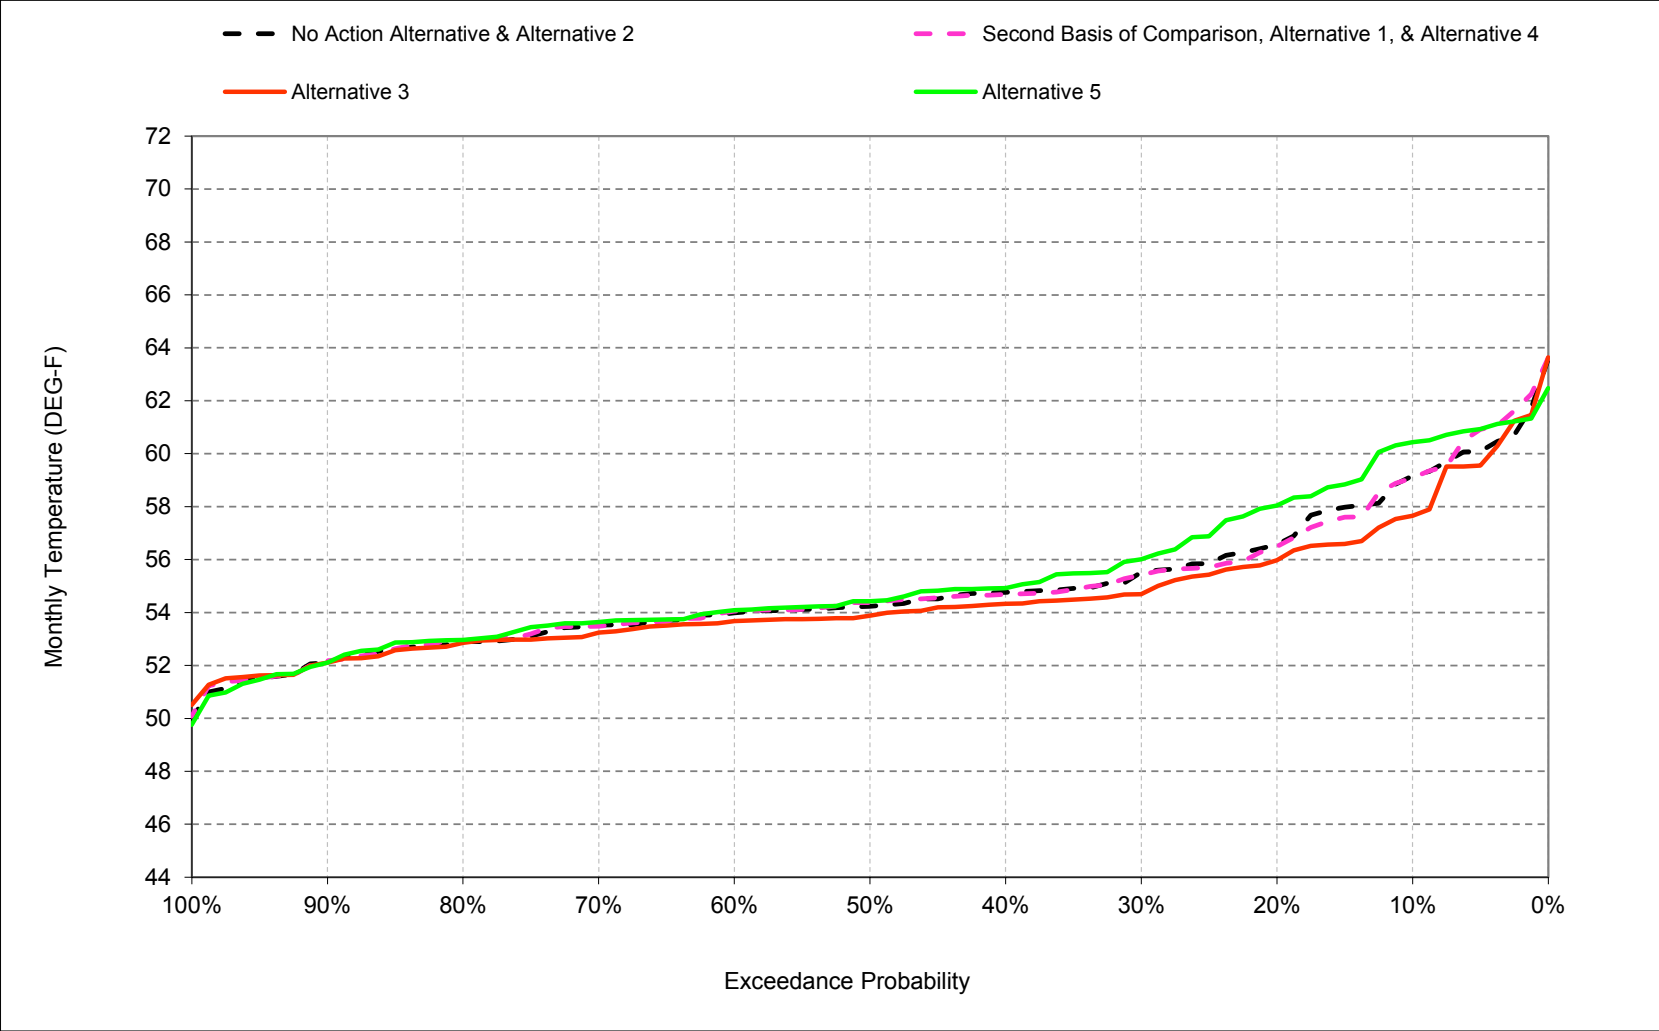


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-17-3. Stanislaus River below Goodwin Dam, December

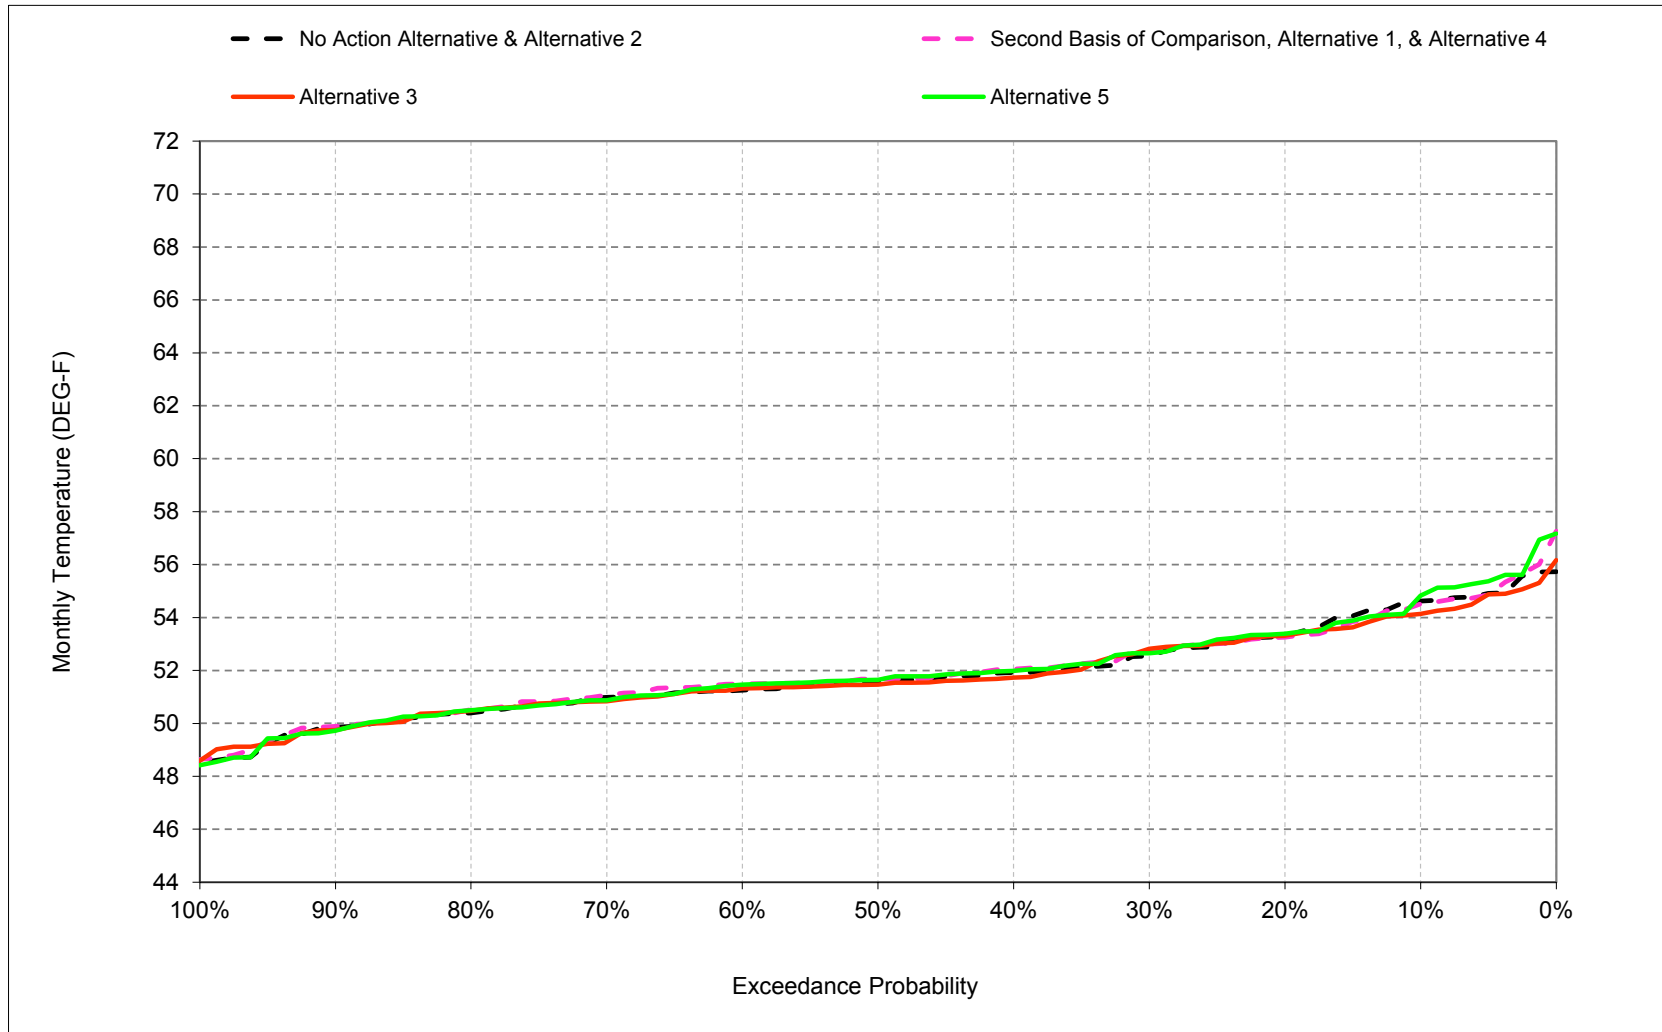


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-17-4. Stanislaus River below Goodwin Dam, January

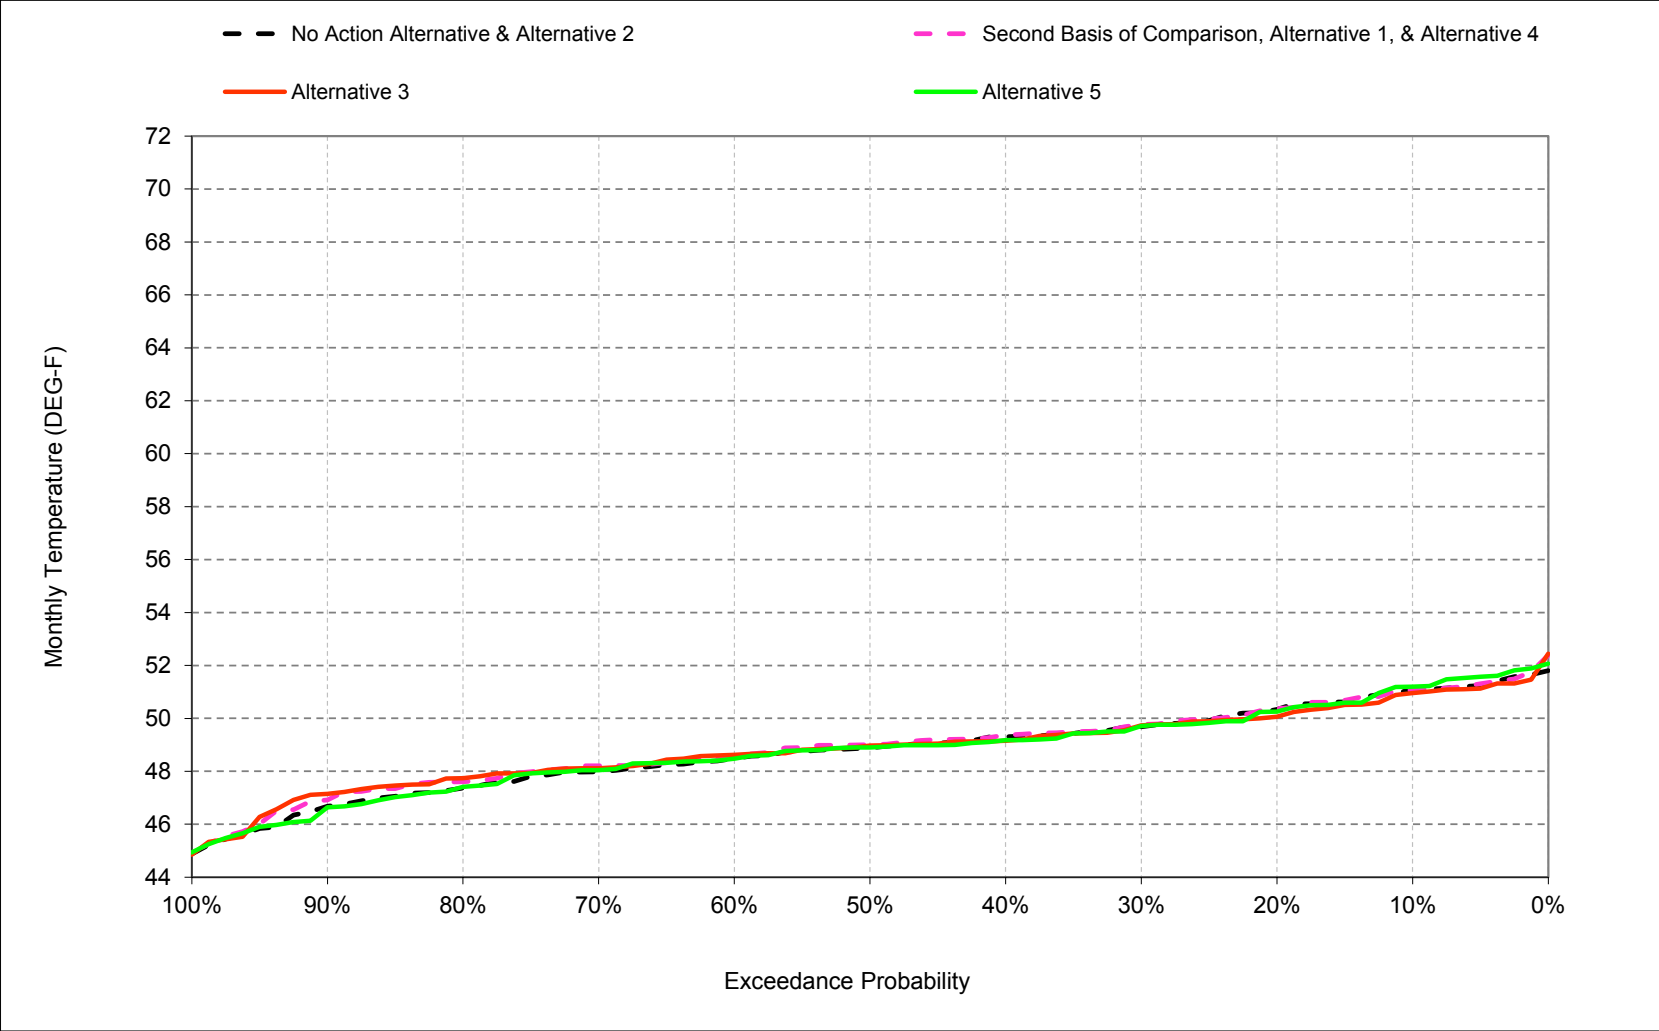


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-17-5. Stanislaus River below Goodwin Dam, February

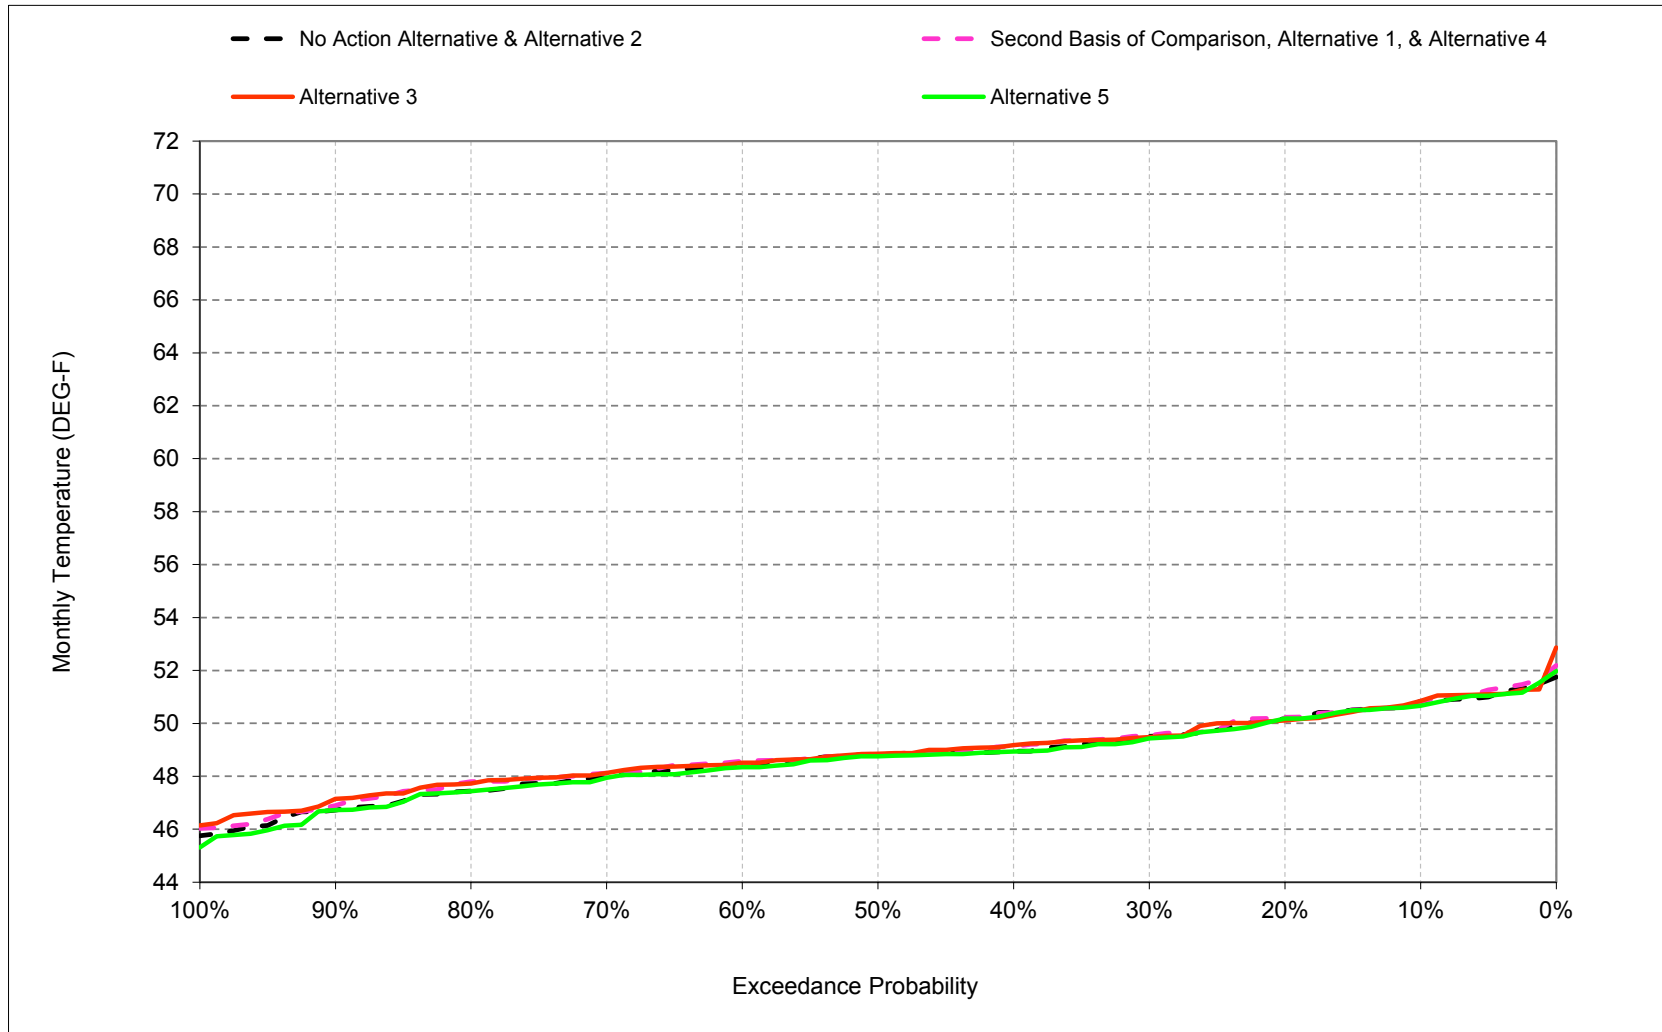


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-17-6. Stanislaus River below Goodwin Dam, March

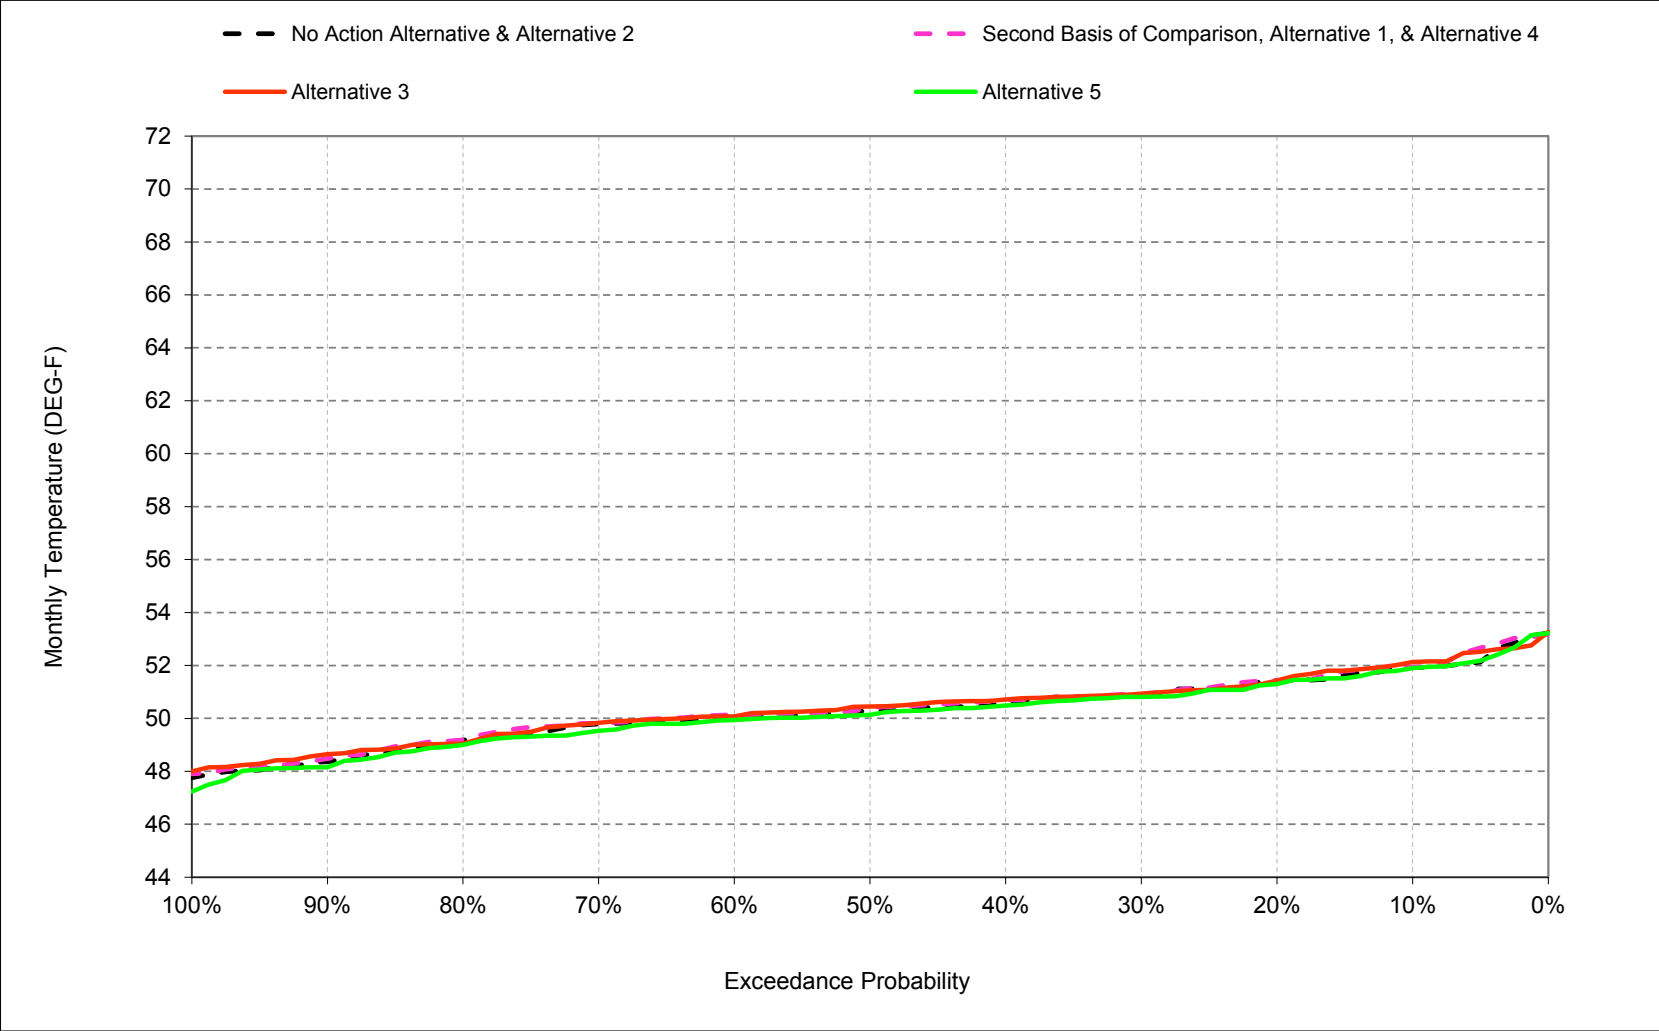


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-17-7. Stanislaus River below Goodwin Dam, April

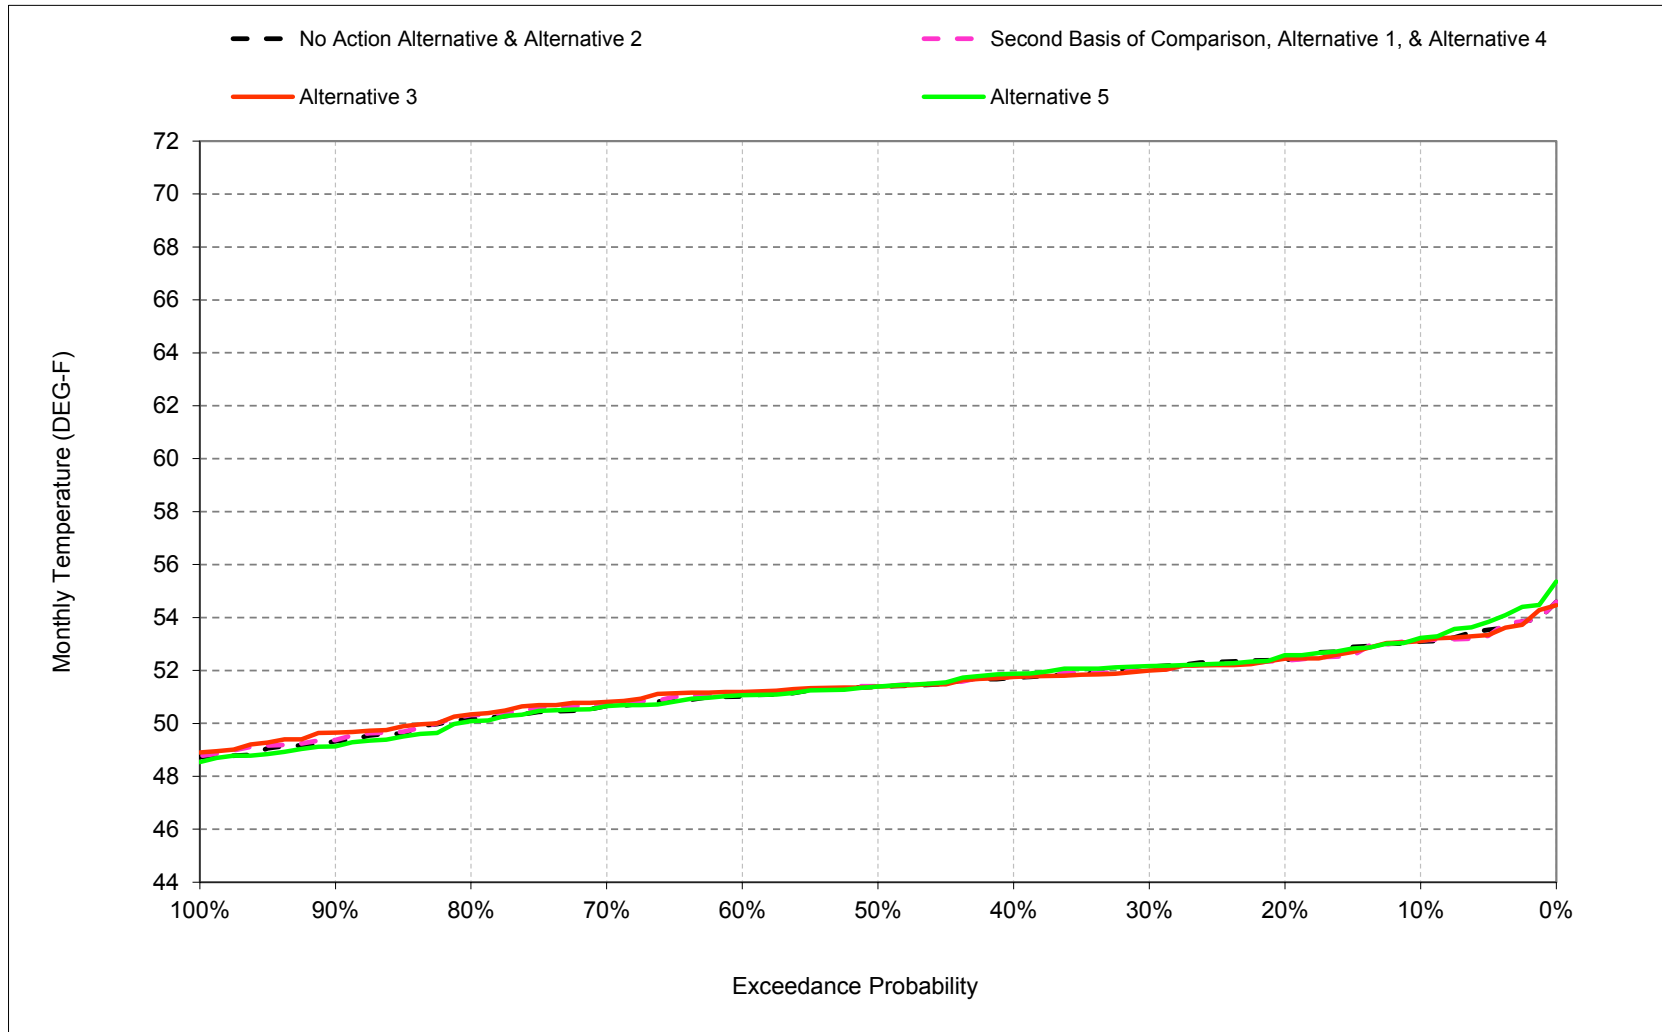


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-17-8. Stanislaus River below Goodwin Dam, May

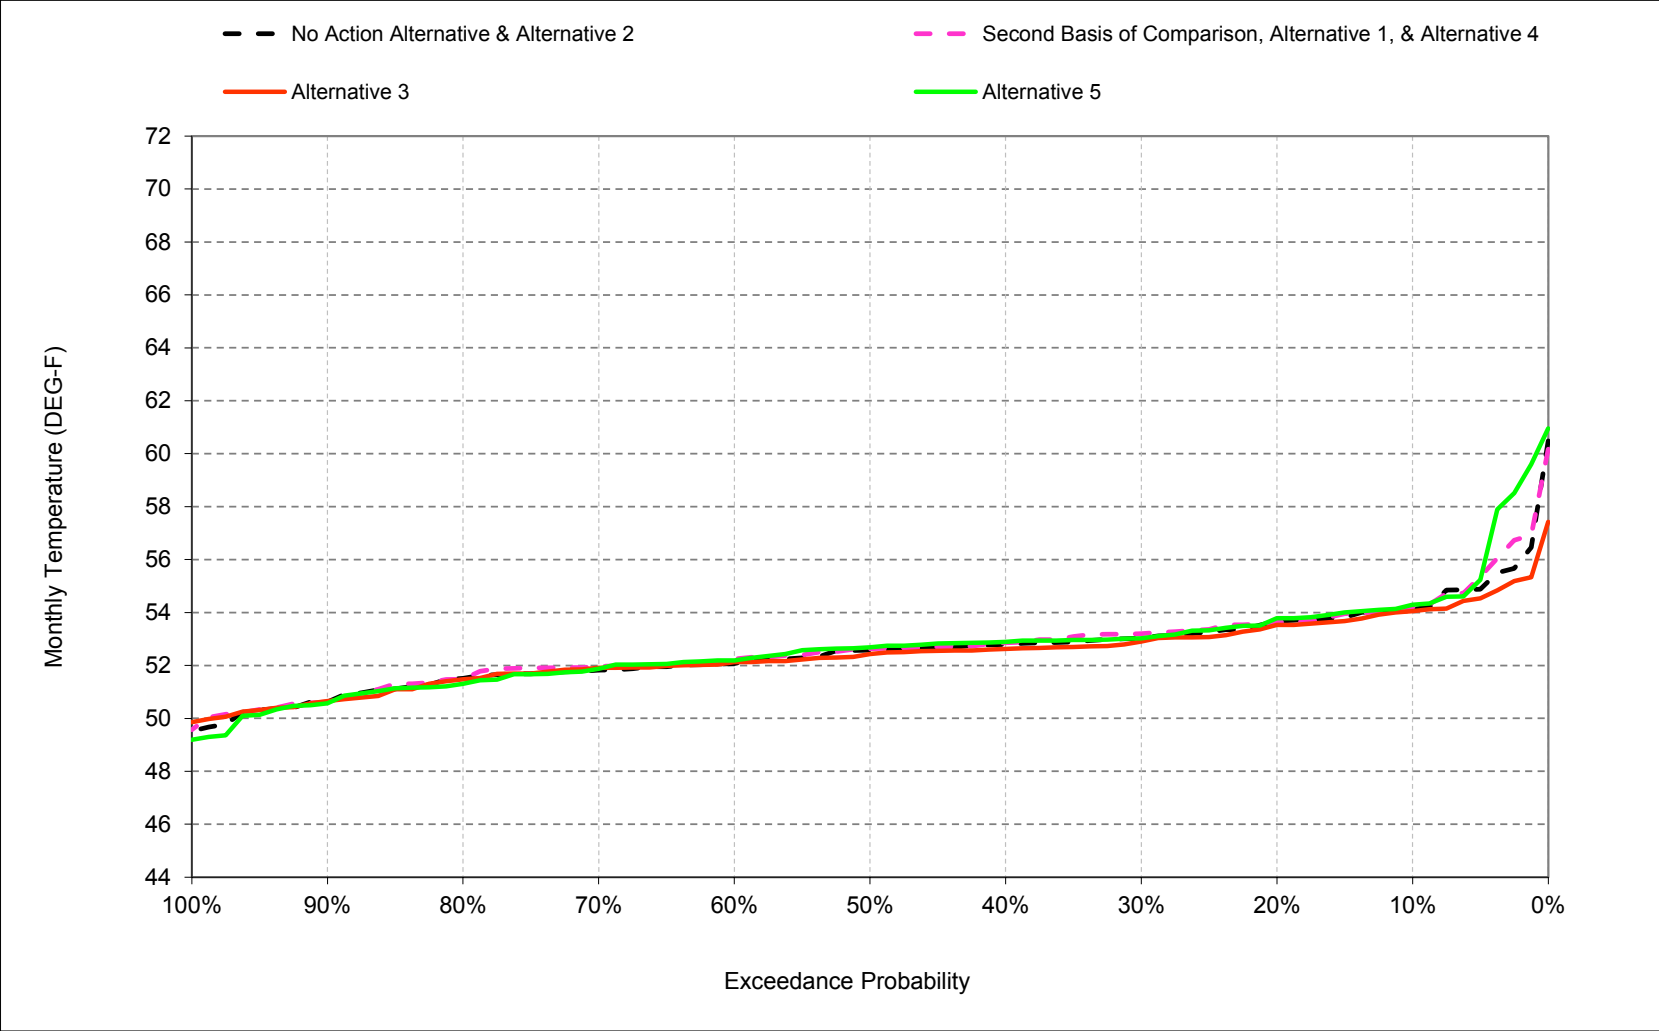


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-17-9. Stanislaus River below Goodwin Dam, June

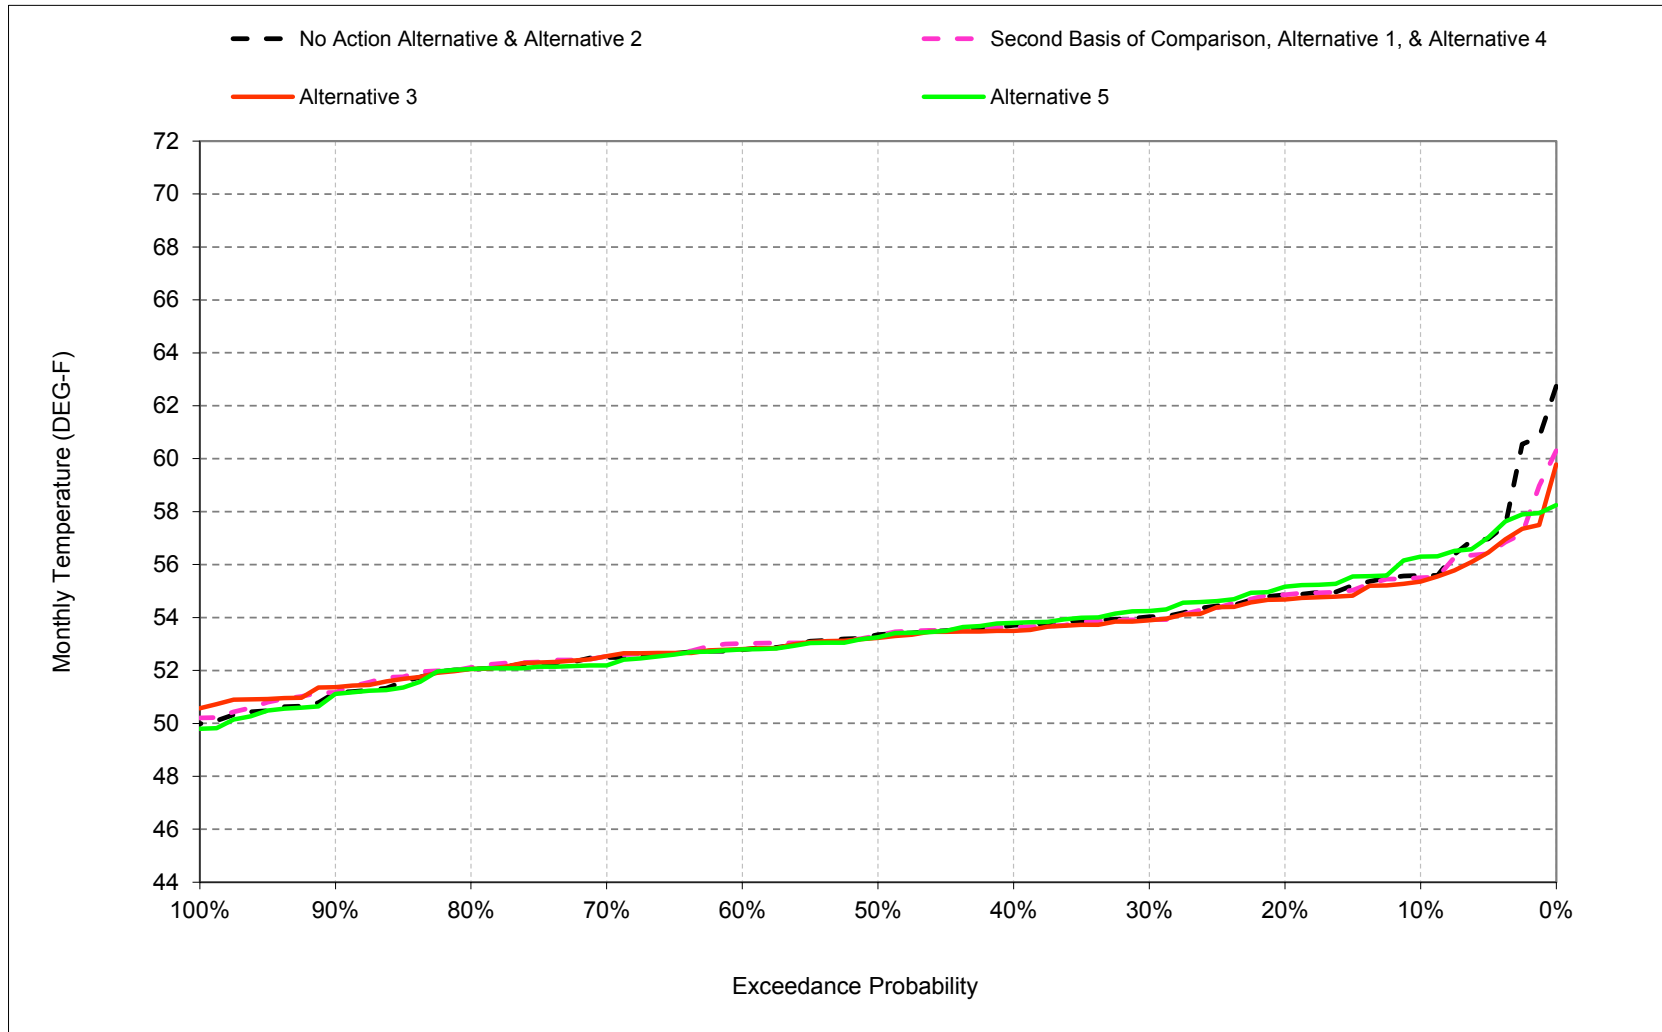


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-17-10. Stanislaus River below Goodwin Dam, July

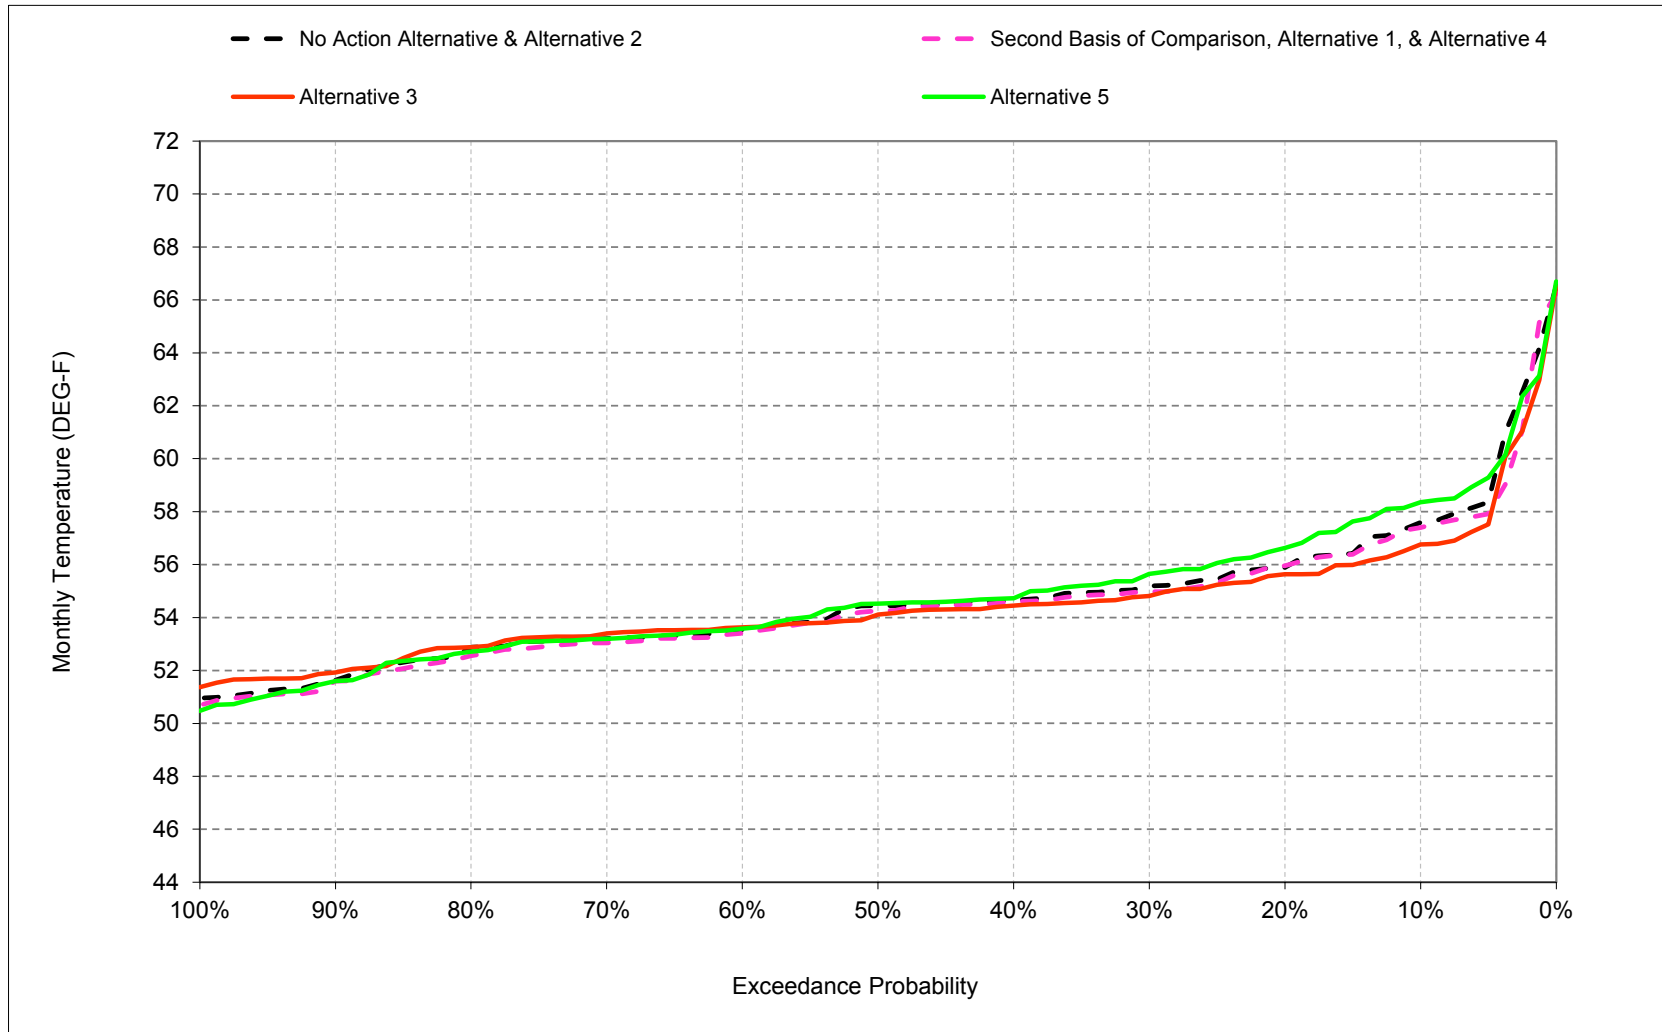


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-17-11. Stanislaus River below Goodwin Dam, August

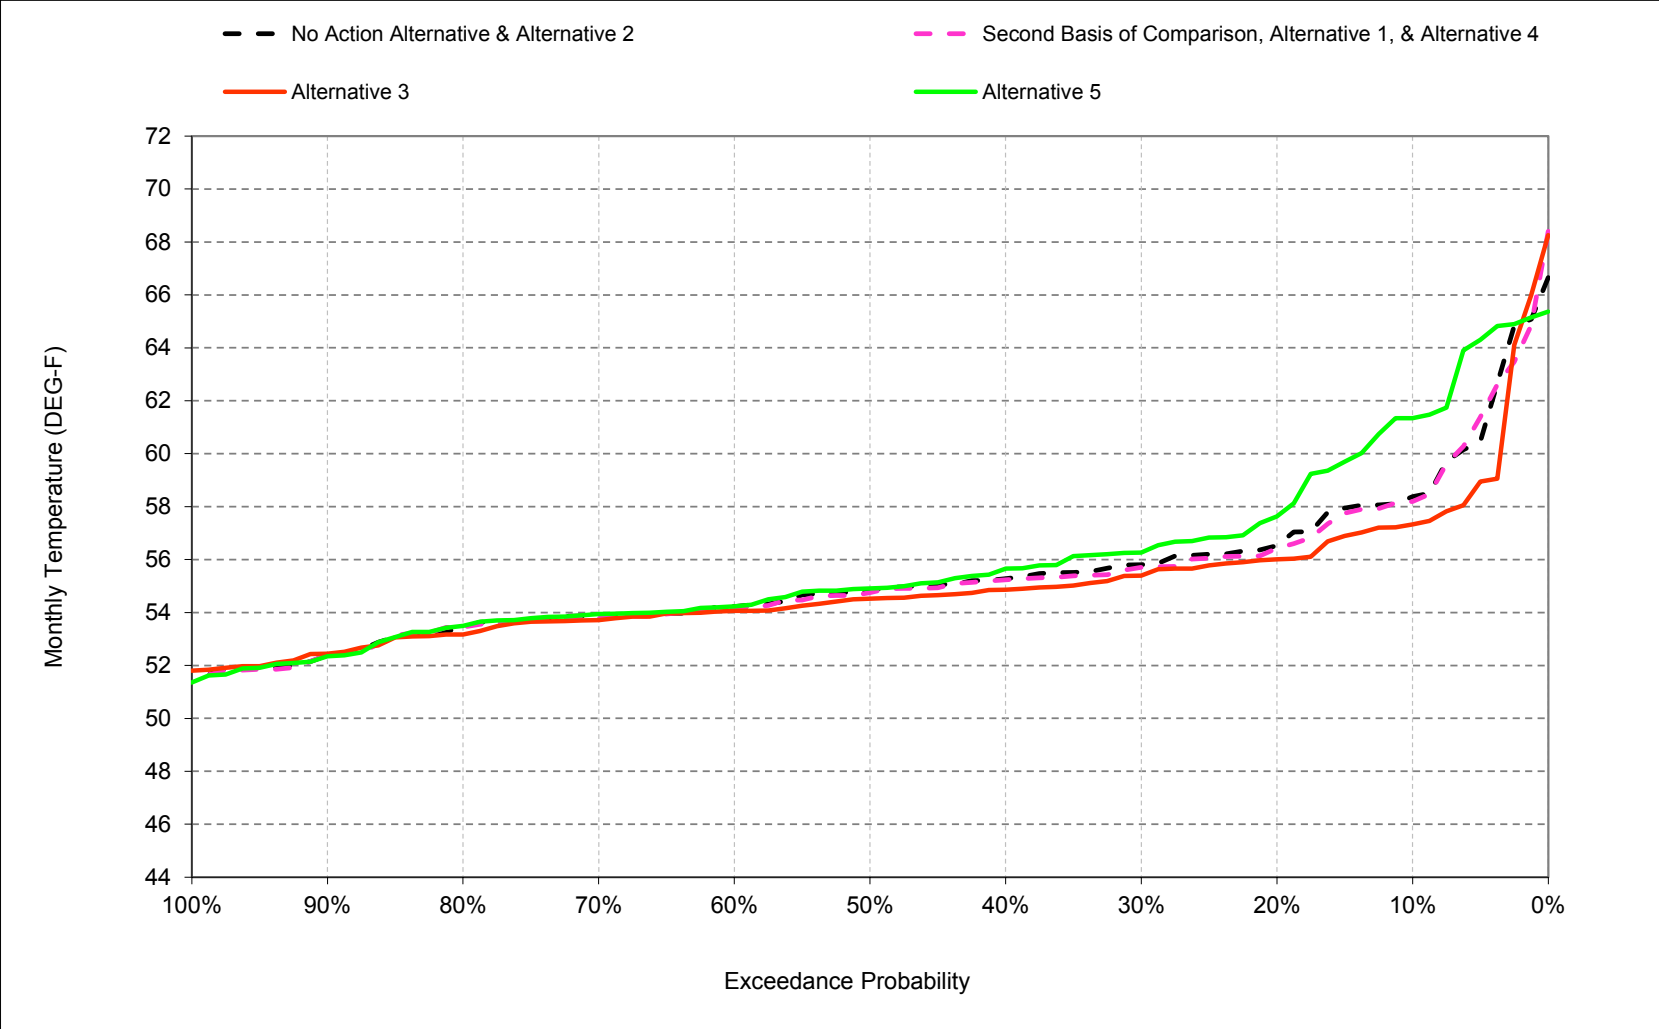

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-17-12. Stanislaus River below Goodwin Dam, September

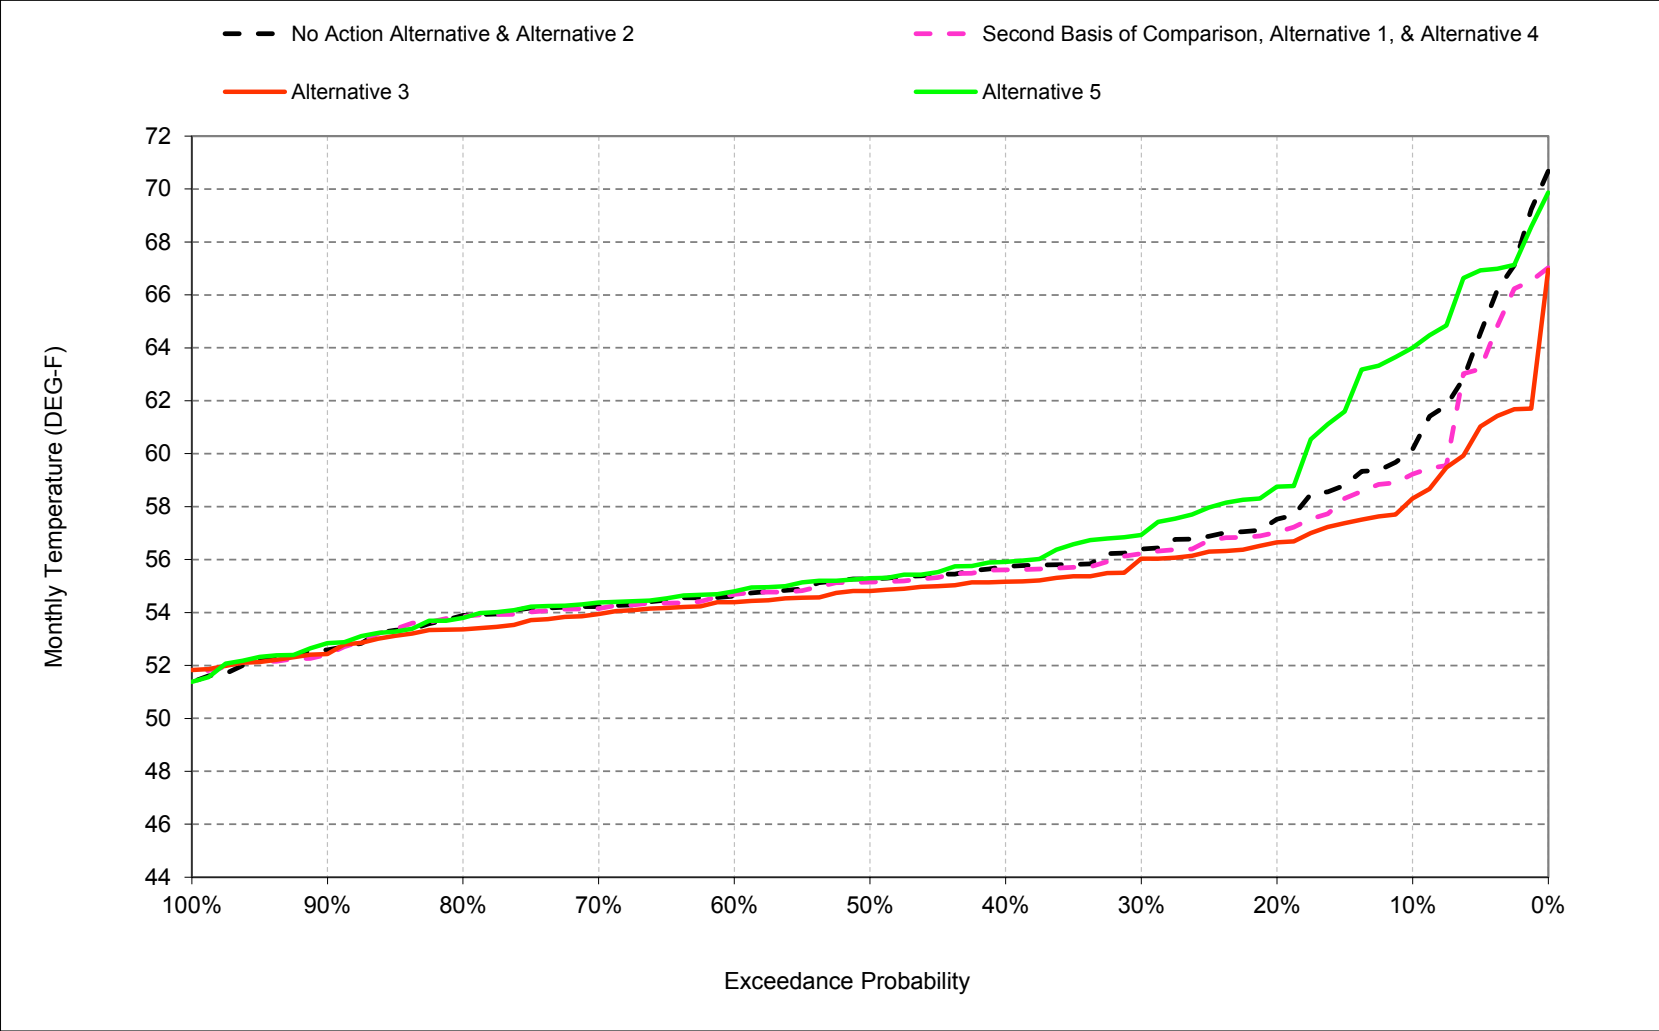

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-17-1. Stanislaus River below Goodwin Dam, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	59	55	51	51	52	53	54	56	58	58	60
20%	58	57	53	50	50	51	52	54	55	56	56	57
30%	56	56	53	50	49	51	52	53	54	55	56	56
40%	55	55	52	49	49	51	52	53	54	55	55	56
50%	55	54	52	49	49	50	51	53	53	54	55	55
60%	55	54	51	48	48	50	51	52	53	53	54	55
70%	54	54	51	48	48	50	51	52	52	53	54	54
80%	54	53	50	47	47	49	50	51	52	53	53	54
90%	52	52	50	46	47	48	49	51	51	52	52	53
Long Term												
Full Simulation Period ^b	56	55	52	49	49	50	51	53	53	55	55	56
Water Year Types ^c												
Wet (32%)	52	52	49	48	48	49	50	52	52	53	53	53
Above Normal (16%)	56	55	52	49	49	50	51	52	53	53	54	55
Below Normal (13%)	55	54	51	49	49	50	52	52	53	54	55	56
Dry (24%)	56	55	52	49	49	51	52	53	54	55	56	57
Critical (15%)	60	58	54	50	50	51	53	55	57	59	60	63

Alternative 1												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	60	59	55	51	51	52	53	54	56	57	58	59
20%	57	56	53	50	50	51	52	54	55	56	56	57
30%	56	55	53	50	50	51	52	53	54	55	56	56
40%	56	55	52	49	49	51	52	53	54	55	55	56
50%	55	54	52	49	49	50	51	53	53	54	55	55
60%	55	54	51	49	49	50	51	52	53	53	54	55
70%	54	53	51	48	48	50	51	52	52	53	54	54
80%	54	53	51	48	48	49	50	51	52	52	53	54
90%	53	52	50	47	47	48	49	51	51	51	52	52
Long Term												
Full Simulation Period ^b	56	55	52	49	49	50	51	53	53	54	55	56
Water Year Types ^c												
Wet (32%)	52	52	49	48	48	49	50	52	52	52	53	53
Above Normal (16%)	56	55	52	49	49	50	51	52	53	53	54	55
Below Normal (13%)	55	54	51	49	49	50	51	53	53	54	55	55
Dry (24%)	56	55	52	49	49	51	52	53	54	55	56	57
Critical (15%)	60	58	54	50	50	52	53	55	56	59	60	61

Alternative 1 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.5	-0.1	-0.1	0.0	0.0	0.0	0.0	0.1	-0.1	-0.2	-0.2	-0.9
0.2	-0.7	-0.1	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.1	-0.1	-0.4
0.3	0.3	-0.1	0.2	0.1	0.1	0.1	-0.1	0.2	-0.1	-0.2	-0.1	-0.2
0.4	0.2	-0.1	0.1	0.0	0.2	0.1	0.0	0.1	0.0	-0.1	0.0	-0.1
0.5	0.3	0.1	0.1	0.1	0.0	0.1	0.0	0.0	0.0	-0.2	-0.1	-0.1
0.6	0.3	0.1	0.2	0.1	0.2	0.1	0.1	0.1	0.3	-0.1	-0.1	0.0
0.7	0.5	0.0	0.1	0.2	0.1	0.1	0.1	0.1	0.0	-0.1	-0.1	-0.1
0.8	0.3	0.0	0.1	0.3	0.3	0.1	0.1	0.0	0.0	-0.2	0.1	0.0
0.9	0.3	0.1	0.0	0.4	0.1	0.0	0.1	0.0	0.3	-0.3	0.0	-0.3
Long Term												
Full Simulation Period ^b	0.0	0.0	0.1	0.1	0.1	0.1	0.0	0.1	-0.1	-0.2	-0.1	-0.3
Water Year Types ^c												
Wet (32%)	0.1	-0.1	0.0	0.1	0.1	0.1	0.1	0.1	0.3	-0.2	0.0	0.0
Above Normal (16%)	0.1	0.0	0.1	0.1	0.1	0.1	0.0	0.2	0.0	-0.1	-0.1	-0.1
Below Normal (13%)	0.0	-0.2	0.0	0.1	0.1	0.1	-0.2	0.2	-0.1	-0.2	-0.2	-0.2
Dry (24%)	0.1	-0.1	0.1	0.1	0.1	0.1	0.1	0.1	-0.1	-0.1	-0.1	-0.3
Critical (15%)	-0.4	0.7	0.4	0.2	0.2	0.2	0.0	0.1	-0.8	-0.3	0.1	-1.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-17-2. Stanislaus River below Goodwin Dam, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	59	55	51	51	52	53	54	56	58	58	60
20%	58	57	53	50	50	51	52	54	55	56	56	57
30%	56	56	53	50	49	51	52	53	54	55	56	56
40%	55	55	52	49	49	51	52	53	54	55	55	56
50%	55	54	52	49	49	50	51	53	53	54	55	55
60%	55	54	51	48	48	50	51	52	53	53	54	55
70%	54	54	51	48	48	50	51	52	52	53	54	54
80%	54	53	50	47	47	49	50	51	52	53	53	54
90%	52	52	50	46	47	48	49	51	51	52	52	53
Long Term												
Full Simulation Period ^b	56	55	52	49	49	50	51	53	53	55	55	56
Water Year Types ^c												
Wet (32%)	52	52	49	48	48	49	50	52	52	53	53	53
Above Normal (16%)	56	55	52	49	49	50	51	52	53	53	54	55
Below Normal (13%)	55	54	51	49	49	50	52	52	53	54	55	56
Dry (24%)	56	55	52	49	49	51	52	53	54	55	56	57
Critical (15%)	60	58	54	50	50	51	53	55	57	59	60	63

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	59	58	54	51	51	52	53	54	55	57	57	58
20%	57	56	53	50	50	51	52	53	55	56	56	57
30%	56	55	53	50	49	51	52	53	54	55	55	56
40%	55	54	52	49	49	51	52	53	53	54	55	55
50%	55	54	51	49	49	50	51	52	53	54	55	55
60%	55	54	51	49	48	50	51	52	53	54	54	54
70%	54	53	51	48	48	50	51	52	52	53	54	54
80%	53	53	50	48	48	49	50	51	52	53	53	53
90%	53	52	50	47	47	49	50	51	51	52	52	52
Long Term												
Full Simulation Period ^b	55	55	52	49	49	50	51	52	53	54	55	55
Water Year Types ^c												
Wet (32%)	52	51	49	48	48	50	50	51	52	53	53	53
Above Normal (16%)	56	55	52	49	49	50	51	52	53	54	54	54
Below Normal (13%)	55	54	51	49	49	50	51	52	53	54	55	55
Dry (24%)	55	54	52	49	49	51	52	53	54	55	55	56
Critical (15%)	59	57	54	50	50	52	53	54	56	58	60	60

Alternative 3 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-2.2	-1.5	-0.5	-0.1	0.0	0.2	0.0	-0.1	-0.2	-0.8	-1.0	-1.9
0.2	-1.0	-0.6	0.0	-0.3	-0.1	0.0	0.0	-0.1	-0.2	-0.3	-0.5	-0.8
0.3	-0.2	-0.8	0.3	0.0	0.0	0.1	-0.1	-0.2	-0.1	-0.3	-0.4	-0.5
0.4	-0.3	-0.4	-0.2	-0.2	0.2	0.1	0.0	-0.2	-0.2	-0.2	-0.4	-0.6
0.5	-0.2	-0.4	-0.1	0.1	0.0	0.2	0.0	-0.2	-0.1	-0.4	-0.3	-0.5
0.6	0.0	-0.3	0.1	0.2	0.1	0.1	0.2	0.0	0.0	0.1	-0.2	-0.2
0.7	0.1	-0.3	-0.2	0.1	0.1	0.0	0.2	0.1	0.0	0.1	-0.2	-0.3
0.8	-0.1	0.0	0.1	0.4	0.3	0.0	0.2	-0.1	0.0	0.3	-0.1	-0.4
0.9	0.2	0.0	-0.1	0.6	0.2	0.2	0.4	0.0	0.5	0.4	0.3	-0.2
Long Term												
Full Simulation Period ^b	-0.5	-0.4	-0.1	0.1	0.2	0.1	0.1	-0.1	-0.1	-0.2	-0.4	-0.8
Water Year Types ^c												
Wet (32%)	-0.2	-0.3	-0.1	0.1	0.4	0.2	0.2	-0.1	0.2	0.2	0.0	-0.2
Above Normal (16%)	-0.4	-0.4	0.0	0.1	0.1	0.1	0.1	0.0	0.1	0.1	-0.2	-0.4
Below Normal (13%)	-0.7	-0.7	-0.3	0.0	0.0	0.1	-0.1	-0.1	0.0	-0.2	-0.4	-0.5
Dry (24%)	-0.2	-0.4	0.0	0.0	0.0	0.0	0.1	-0.1	-0.1	-0.3	-0.6	-0.9
Critical (15%)	-1.7	-0.1	0.2	0.1	0.2	0.2	0.0	-0.7	-1.2	-0.9	-0.8	-2.9

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-17-3. Stanislaus River below Goodwin Dam, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	59	55	51	51	52	53	54	56	58	58	60
20%	58	57	53	50	50	51	52	54	55	56	56	57
30%	56	56	53	50	49	51	52	53	54	55	56	56
40%	55	55	52	49	49	51	52	53	54	55	55	56
50%	55	54	52	49	49	50	51	53	53	54	55	55
60%	55	54	51	48	48	50	51	52	53	53	54	55
70%	54	54	51	48	48	50	51	52	52	53	54	54
80%	54	53	50	47	47	49	50	51	52	53	53	54
90%	52	52	50	46	47	48	49	51	51	52	52	53
Long Term												
Full Simulation Period ^b	56	55	52	49	49	50	51	53	53	55	55	56
Water Year Types ^c												
Wet (32%)	52	52	49	48	48	49	50	52	52	53	53	53
Above Normal (16%)	56	55	52	49	49	50	51	52	53	53	54	55
Below Normal (13%)	55	54	51	49	49	50	52	52	53	54	55	56
Dry (24%)	56	55	52	49	49	51	52	53	54	55	56	57
Critical (15%)	60	58	54	50	50	51	53	55	57	59	60	63

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	65	60	55	51	51	52	53	54	56	58	61	64
20%	59	58	53	50	50	51	53	54	55	57	58	59
30%	57	56	53	50	49	51	52	53	54	56	56	57
40%	56	55	52	49	49	50	52	53	54	55	56	56
50%	55	54	52	49	49	50	51	53	53	55	55	55
60%	55	54	51	48	48	50	51	52	53	54	54	55
70%	54	54	51	48	48	49	51	52	53	53	54	54
80%	54	53	50	47	47	49	50	51	52	53	53	54
90%	52	52	50	46	47	48	49	51	51	51	52	53
Long Term												
Full Simulation Period ^b	57	55	52	49	49	50	51	53	53	55	56	57
Water Year Types ^c												
Wet (32%)	53	52	49	48	48	49	50	51	52	52	53	54
Above Normal (16%)	57	55	52	49	49	50	51	52	53	54	54	55
Below Normal (13%)	56	54	51	49	49	50	52	53	53	55	56	56
Dry (24%)	56	55	52	49	49	51	52	53	54	56	57	58
Critical (15%)	61	58	53	50	50	51	53	56	57	59	61	63

Alternative 5 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	4.0	1.3	0.2	0.1	-0.2	0.0	0.1	0.2	0.7	0.8	3.0	3.9
0.2	0.8	1.5	0.1	-0.1	0.0	-0.1	0.1	0.1	0.3	0.7	1.1	1.2
0.3	0.6	0.5	0.1	0.0	-0.1	0.0	0.0	0.0	0.2	0.4	0.5	0.6
0.4	0.2	0.2	0.1	-0.2	0.0	-0.1	0.2	0.1	0.1	0.1	0.3	0.2
0.5	0.2	0.2	0.1	0.0	-0.1	-0.1	0.0	0.1	-0.1	0.1	0.1	0.0
0.6	0.3	0.1	0.2	0.0	0.0	-0.1	0.0	0.1	0.0	0.1	0.0	0.1
0.7	0.2	0.1	-0.1	0.1	-0.1	-0.3	0.0	0.0	-0.3	0.0	0.0	0.1
0.8	0.1	0.1	0.1	0.0	0.0	-0.1	-0.1	-0.2	0.0	0.0	0.1	0.0
0.9	0.1	0.0	-0.1	-0.3	0.0	-0.2	-0.1	-0.1	-0.1	0.0	0.0	0.1
Long Term												
Full Simulation Period ^b	0.6	0.4	0.1	0.0	-0.1	-0.1	0.0	0.1	-0.1	0.2	0.5	0.6
Water Year Types ^c												
Wet (32%)	0.7	0.3	0.1	0.0	-0.1	-0.1	-0.1	-0.1	-0.1	0.0	0.1	0.2
Above Normal (16%)	0.4	0.4	0.2	0.1	0.0	-0.1	-0.1	0.1	-0.1	0.1	0.2	0.3
Below Normal (13%)	0.7	0.0	0.1	0.0	-0.1	-0.1	0.0	0.1	0.2	0.4	0.6	0.8
Dry (24%)	0.7	0.5	0.2	0.1	0.0	-0.1	0.0	0.0	0.2	0.5	1.1	1.6
Critical (15%)	0.5	0.7	-0.1	-0.2	-0.3	-0.2	0.5	0.8	-0.7	0.0	0.9	0.4

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on an 81-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-17-4. Stanislaus River below Goodwin Dam, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	60	59	55	51	51	52	53	54	56	57	58	59
20%	57	56	53	50	50	51	52	54	55	56	56	57
30%	56	55	53	50	50	51	52	53	54	55	56	56
40%	56	55	52	49	49	51	52	53	54	55	55	56
50%	55	54	52	49	49	50	51	53	53	54	55	55
60%	55	54	51	49	49	50	51	52	53	53	54	55
70%	54	53	51	48	48	50	51	52	52	53	54	54
80%	54	53	51	48	48	49	50	51	52	52	53	54
90%	53	52	50	47	47	48	49	51	51	51	52	52
Long Term												
Full Simulation Period ^b	56	55	52	49	49	50	51	53	53	54	55	56
Water Year Types ^c												
Wet (32%)	52	52	49	48	48	49	50	52	52	52	53	53
Above Normal (16%)	56	55	52	49	49	50	51	52	53	53	54	55
Below Normal (13%)	55	54	51	49	49	50	51	53	53	54	55	55
Dry (24%)	56	55	52	49	49	51	52	53	54	55	56	57
Critical (15%)	60	58	54	50	50	52	53	55	56	59	60	61

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	59	55	51	51	52	53	54	56	58	58	60
20%	58	57	53	50	50	51	52	54	55	56	56	57
30%	56	56	53	50	49	51	52	53	54	55	56	56
40%	55	55	52	49	49	51	52	53	54	55	55	56
50%	55	54	52	49	49	50	51	53	53	54	55	55
60%	55	54	51	48	48	50	51	52	53	53	54	55
70%	54	54	51	48	48	50	51	52	53	53	54	54
80%	54	53	50	47	47	49	50	51	52	53	53	54
90%	52	52	50	46	47	48	49	51	51	52	52	53
Long Term												
Full Simulation Period ^b	56	55	52	49	49	50	51	53	53	55	55	56
Water Year Types ^c												
Wet (32%)	52	52	49	48	48	49	50	52	52	53	53	53
Above Normal (16%)	56	55	52	49	49	50	51	52	53	53	54	55
Below Normal (13%)	55	54	51	49	49	50	52	52	53	54	55	56
Dry (24%)	56	55	52	49	49	51	52	53	54	55	56	57
Critical (15%)	60	58	54	50	50	51	53	55	57	59	60	63

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.5	0.1	0.1	0.0	0.0	0.0	0.0	-0.1	0.1	0.2	0.2	0.9
0.2	0.7	0.1	0.0	0.0	-0.1	0.0	0.0	0.0	0.0	-0.1	0.1	0.4
0.3	-0.3	0.1	-0.2	-0.1	-0.1	-0.1	0.1	-0.2	0.1	0.2	0.1	0.2
0.4	-0.2	0.1	-0.1	0.0	-0.2	-0.1	0.0	-0.1	0.0	0.1	0.0	0.1
0.5	-0.3	-0.1	-0.1	-0.1	0.0	-0.1	0.0	0.0	0.0	0.2	0.1	0.1
0.6	-0.3	-0.1	-0.2	-0.1	-0.2	-0.1	-0.1	-0.1	-0.3	0.1	0.1	0.0
0.7	-0.5	0.0	-0.1	-0.2	-0.1	-0.1	-0.1	-0.1	0.0	0.1	0.1	0.1
0.8	-0.3	0.0	-0.1	-0.3	-0.3	-0.1	-0.1	0.0	0.0	0.2	-0.1	0.0
0.9	-0.3	-0.1	0.0	-0.4	-0.1	0.0	-0.1	0.0	-0.3	0.3	0.0	0.3
Long Term												
Full Simulation Period ^b	0.0	0.0	-0.1	-0.1	-0.1	-0.1	0.0	-0.1	0.1	0.2	0.1	0.3
Water Year Types ^c												
Wet (32%)	-0.1	0.1	0.0	-0.1	-0.1	-0.1	-0.1	-0.1	-0.3	0.2	0.0	0.0
Above Normal (16%)	-0.1	0.0	-0.1	-0.1	-0.1	-0.1	0.0	-0.2	0.0	0.1	0.1	0.1
Below Normal (13%)	0.0	0.2	0.0	-0.1	-0.1	-0.1	0.2	-0.2	0.1	0.2	0.2	0.2
Dry (24%)	-0.1	0.1	-0.1	-0.1	-0.1	-0.1	-0.1	-0.1	0.1	0.1	0.1	0.3
Critical (15%)	0.4	-0.7	-0.4	-0.2	-0.2	-0.2	0.0	-0.1	0.8	0.3	-0.1	1.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-17-5. Stanislaus River below Goodwin Dam, Monthly Temperature

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	60	59	55	51	51	52	53	54	56	57	58	59
20%	57	56	53	50	50	51	52	54	55	56	56	57
30%	56	55	53	50	50	51	52	53	54	55	56	56
40%	56	55	52	49	49	51	52	53	54	55	55	56
50%	55	54	52	49	49	50	51	53	53	54	55	55
60%	55	54	51	49	49	50	51	52	53	53	54	55
70%	54	53	51	48	48	50	51	52	52	53	54	54
80%	54	53	51	48	48	49	50	51	52	52	53	54
90%	53	52	50	47	47	48	49	51	51	51	52	52
Long Term												
Full Simulation Period ^b	56	55	52	49	49	50	51	53	53	54	55	56
Water Year Types ^c												
Wet (32%)	52	52	49	48	48	49	50	52	52	52	53	53
Above Normal (16%)	56	55	52	49	49	50	51	52	53	53	54	55
Below Normal (13%)	55	54	51	49	49	50	51	53	53	54	55	55
Dry (24%)	56	55	52	49	49	51	52	53	54	55	56	57
Critical (15%)	60	58	54	50	50	52	53	55	56	59	60	61

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 3												
Probability of Exceedance ^a												
10%	59	58	54	51	51	52	53	54	55	57	57	58
20%	57	56	53	50	50	51	52	53	55	56	56	57
30%	56	55	53	50	49	51	52	53	54	55	55	56
40%	55	54	52	49	49	51	52	53	53	54	55	55
50%	55	54	51	49	49	50	51	52	53	54	55	55
60%	55	54	51	49	48	50	51	52	53	54	54	54
70%	54	53	51	48	48	50	51	52	52	53	54	54
80%	53	53	50	48	48	49	50	51	52	53	53	53
90%	53	52	50	47	47	49	50	51	51	52	52	52
Long Term												
Full Simulation Period ^b	55	55	52	49	49	50	51	52	53	54	55	55
Water Year Types ^c												
Wet (32%)	52	51	49	48	48	50	50	51	52	53	53	53
Above Normal (16%)	56	55	52	49	49	50	51	52	53	54	54	54
Below Normal (13%)	55	54	51	49	49	50	51	52	53	54	55	55
Dry (24%)	55	54	52	49	49	51	52	53	54	55	55	56
Critical (15%)	59	57	54	50	50	52	53	54	56	58	60	60

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 3 minus Second Basis of Comparison												
Probability of Exceedance ^a												
0.1	-1.7	-1.4	-0.4	-0.1	0.0	0.2	0.0	-0.2	-0.2	-0.7	-0.9	-0.9
0.2	-0.3	-0.5	0.1	-0.3	-0.1	0.0	0.1	-0.1	-0.2	-0.3	-0.4	-0.4
0.3	-0.4	-0.7	0.1	-0.1	-0.1	0.0	0.0	-0.3	0.0	-0.2	-0.3	-0.3
0.4	-0.5	-0.4	-0.3	-0.2	0.0	0.0	0.0	-0.2	-0.1	-0.1	-0.4	-0.4
0.5	-0.4	-0.5	-0.2	-0.1	0.0	0.1	0.0	-0.2	-0.1	-0.2	-0.2	-0.3
0.6	-0.3	-0.4	-0.2	0.1	-0.1	-0.1	0.0	-0.1	-0.2	0.2	0.0	-0.2
0.7	-0.4	-0.2	-0.2	-0.1	0.0	0.0	0.1	-0.1	0.0	0.3	-0.1	-0.3
0.8	-0.5	-0.1	-0.1	0.1	0.0	-0.1	0.0	-0.1	0.0	0.4	-0.3	-0.4
0.9	-0.1	-0.1	-0.1	0.3	0.1	0.2	0.3	0.0	0.2	0.6	0.2	0.1
Long Term												
Full Simulation Period ^b	-0.5	-0.4	-0.1	-0.1	0.0	0.0	0.0	-0.3	-0.1	0.0	-0.3	-0.5
Water Year Types ^c												
Wet (32%)	-0.3	-0.2	-0.1	0.0	0.2	0.1	0.1	-0.1	-0.1	0.5	0.0	-0.2
Above Normal (16%)	-0.5	-0.4	-0.2	0.0	0.0	0.0	0.1	-0.1	0.1	0.2	-0.1	-0.3
Below Normal (13%)	-0.7	-0.5	-0.2	-0.1	-0.1	0.0	0.0	-0.3	0.1	-0.1	-0.2	-0.3
Dry (24%)	-0.3	-0.3	-0.1	-0.1	-0.1	0.0	0.0	-0.1	-0.1	-0.2	-0.5	-0.7
Critical (15%)	-1.3	-0.8	-0.2	-0.1	0.0	0.1	0.0	-0.8	-0.4	-0.6	-0.9	-1.5

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-17-6. Stanislaus River below Goodwin Dam, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	60	59	55	51	51	52	53	54	56	57	58	59
20%	57	56	53	50	50	51	52	54	55	56	56	57
30%	56	55	53	50	50	51	52	53	54	55	56	56
40%	56	55	52	49	49	51	52	53	54	55	55	56
50%	55	54	52	49	49	50	51	53	53	54	55	55
60%	55	54	51	49	49	50	51	52	53	53	54	55
70%	54	53	51	48	48	50	51	52	52	53	54	54
80%	54	53	51	48	48	49	50	51	52	52	53	54
90%	53	52	50	47	47	48	49	51	51	51	52	52
Long Term												
Full Simulation Period ^b	56	55	52	49	49	50	51	53	53	54	55	56
Water Year Types ^c												
Wet (32%)	52	52	49	48	48	49	50	52	52	52	53	53
Above Normal (16%)	56	55	52	49	49	50	51	52	53	53	54	55
Below Normal (13%)	55	54	51	49	49	50	51	53	53	54	55	55
Dry (24%)	56	55	52	49	49	51	52	53	54	55	56	57
Critical (15%)	60	58	54	50	50	52	53	55	56	59	60	61

Alternative 5

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	65	60	55	51	51	52	53	54	56	58	61	64
20%	59	58	53	50	50	51	53	54	55	57	58	59
30%	57	56	53	50	49	51	52	53	54	56	56	57
40%	56	55	52	49	49	50	52	53	54	55	56	56
50%	55	54	52	49	49	50	51	53	53	55	55	55
60%	55	54	51	48	48	50	51	52	53	54	54	55
70%	54	54	51	48	48	49	51	52	53	53	54	54
80%	54	53	50	47	47	49	50	51	52	53	53	54
90%	52	52	50	46	47	48	49	51	51	51	52	53
Long Term												
Full Simulation Period ^b	57	55	52	49	49	50	51	53	53	55	56	57
Water Year Types ^c												
Wet (32%)	53	52	49	48	48	49	50	51	52	52	53	54
Above Normal (16%)	57	55	52	49	49	50	51	52	53	54	54	55
Below Normal (13%)	56	54	51	49	49	50	52	53	53	55	56	56
Dry (24%)	56	55	52	49	49	51	52	53	54	56	57	58
Critical (15%)	61	58	53	50	50	51	53	56	57	59	61	63

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	4.5	1.4	0.3	0.1	-0.2	-0.1	0.1	0.1	0.8	1.0	3.2	4.8
0.2	1.4	1.6	0.1	-0.1	-0.1	-0.1	0.2	0.1	0.3	0.6	1.2	1.7
0.3	0.3	0.6	-0.1	-0.1	-0.1	-0.1	0.2	-0.2	0.3	0.6	0.6	0.7
0.4	0.0	0.2	-0.1	-0.2	-0.2	-0.2	0.1	0.0	0.2	0.1	0.4	0.3
0.5	0.0	0.1	0.0	-0.1	-0.1	-0.2	0.0	0.0	0.0	0.3	0.2	0.1
0.6	-0.1	0.0	0.0	-0.1	-0.2	-0.2	-0.1	0.0	-0.2	0.2	0.1	0.1
0.7	-0.3	0.2	-0.2	-0.2	-0.3	-0.3	-0.1	-0.1	-0.3	0.1	0.1	0.2
0.8	-0.2	0.0	0.0	-0.3	-0.3	-0.2	-0.2	-0.2	0.0	0.2	0.0	-0.1
0.9	-0.2	-0.1	-0.2	-0.7	-0.1	-0.2	-0.2	-0.1	-0.5	0.2	0.0	0.4
Long Term												
Full Simulation Period ^b	0.6	0.4	0.0	-0.1	-0.2	-0.2	0.0	0.0	0.0	0.4	0.6	1.0
Water Year Types ^c												
Wet (32%)	0.6	0.4	0.1	-0.1	-0.2	-0.2	-0.2	-0.1	-0.4	0.2	0.1	0.2
Above Normal (16%)	0.3	0.4	0.1	0.0	-0.1	-0.1	-0.1	-0.1	-0.1	0.2	0.3	0.4
Below Normal (13%)	0.7	0.2	0.1	-0.1	-0.2	-0.2	0.1	-0.1	0.3	0.5	0.8	1.0
Dry (24%)	0.5	0.5	0.1	0.0	-0.1	-0.1	-0.1	0.0	0.2	0.6	1.2	1.9
Critical (15%)	0.8	0.0	-0.5	-0.4	-0.5	-0.4	0.5	0.7	0.1	0.3	0.8	1.7

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


B.18. Stanislaus River at Orange Blossom Bridge Temperature

Figure B-18-1. Stanislaus River at Orange Blossom Bridge, October

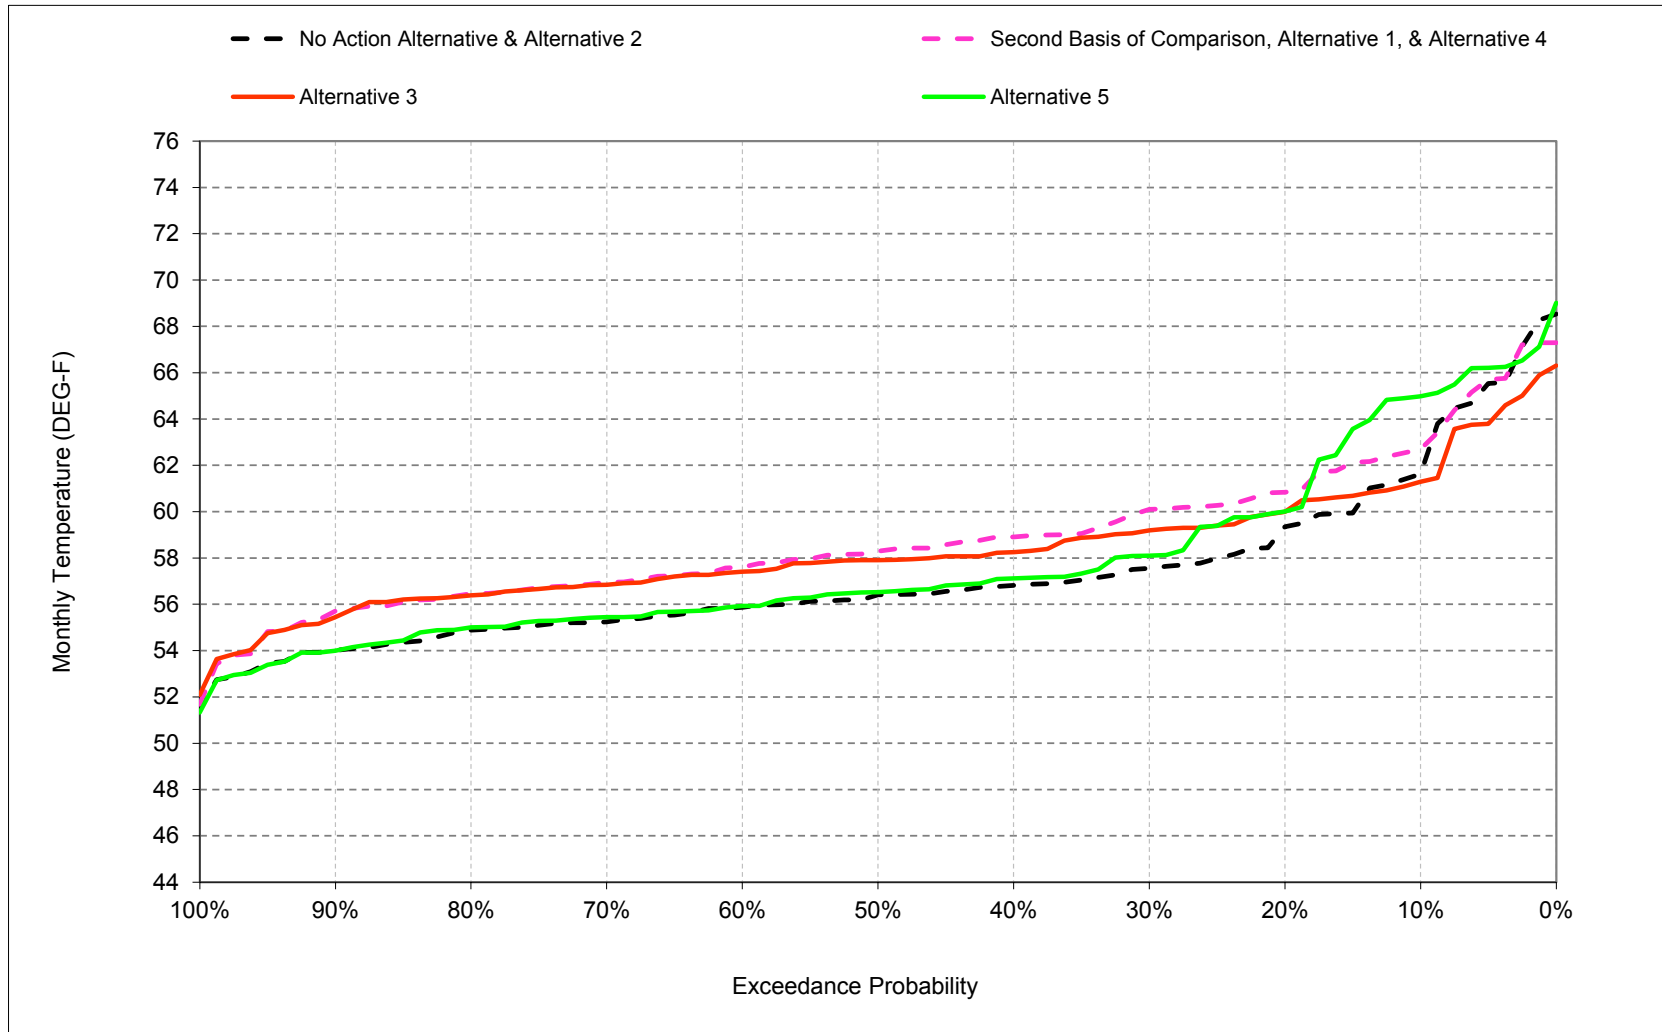


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-18-2. Stanislaus River at Orange Blossom Bridge, November

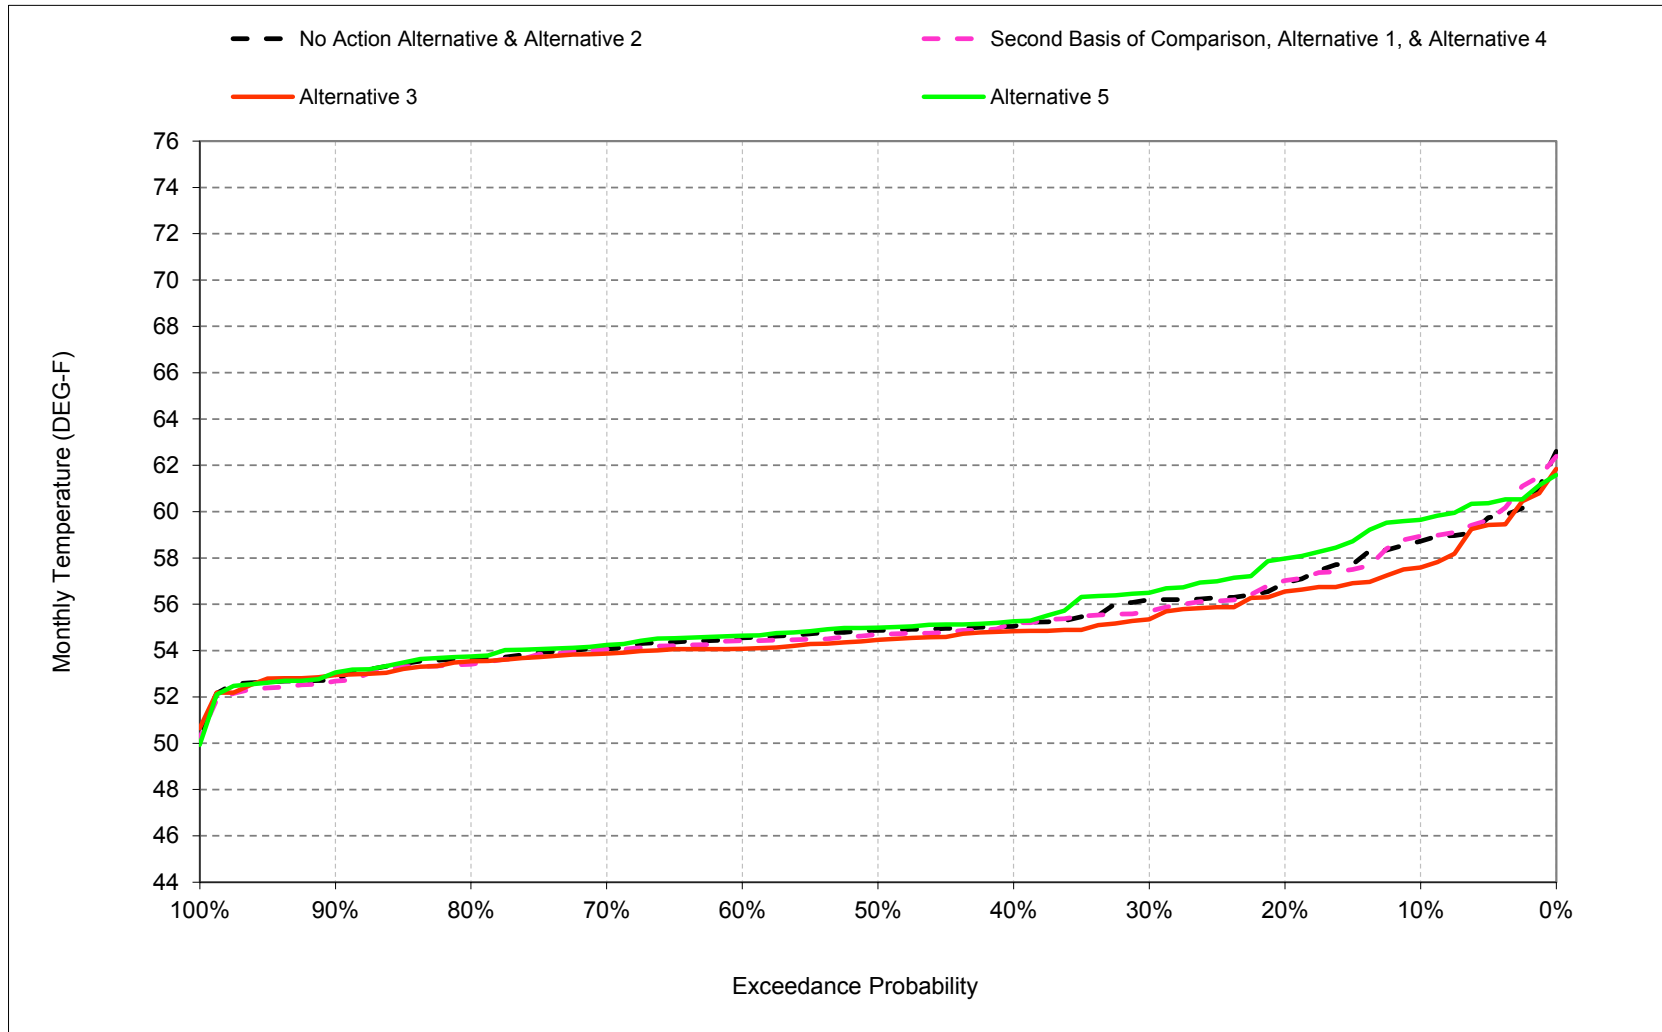


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-18-3. Stanislaus River at Orange Blossom Bridge, December

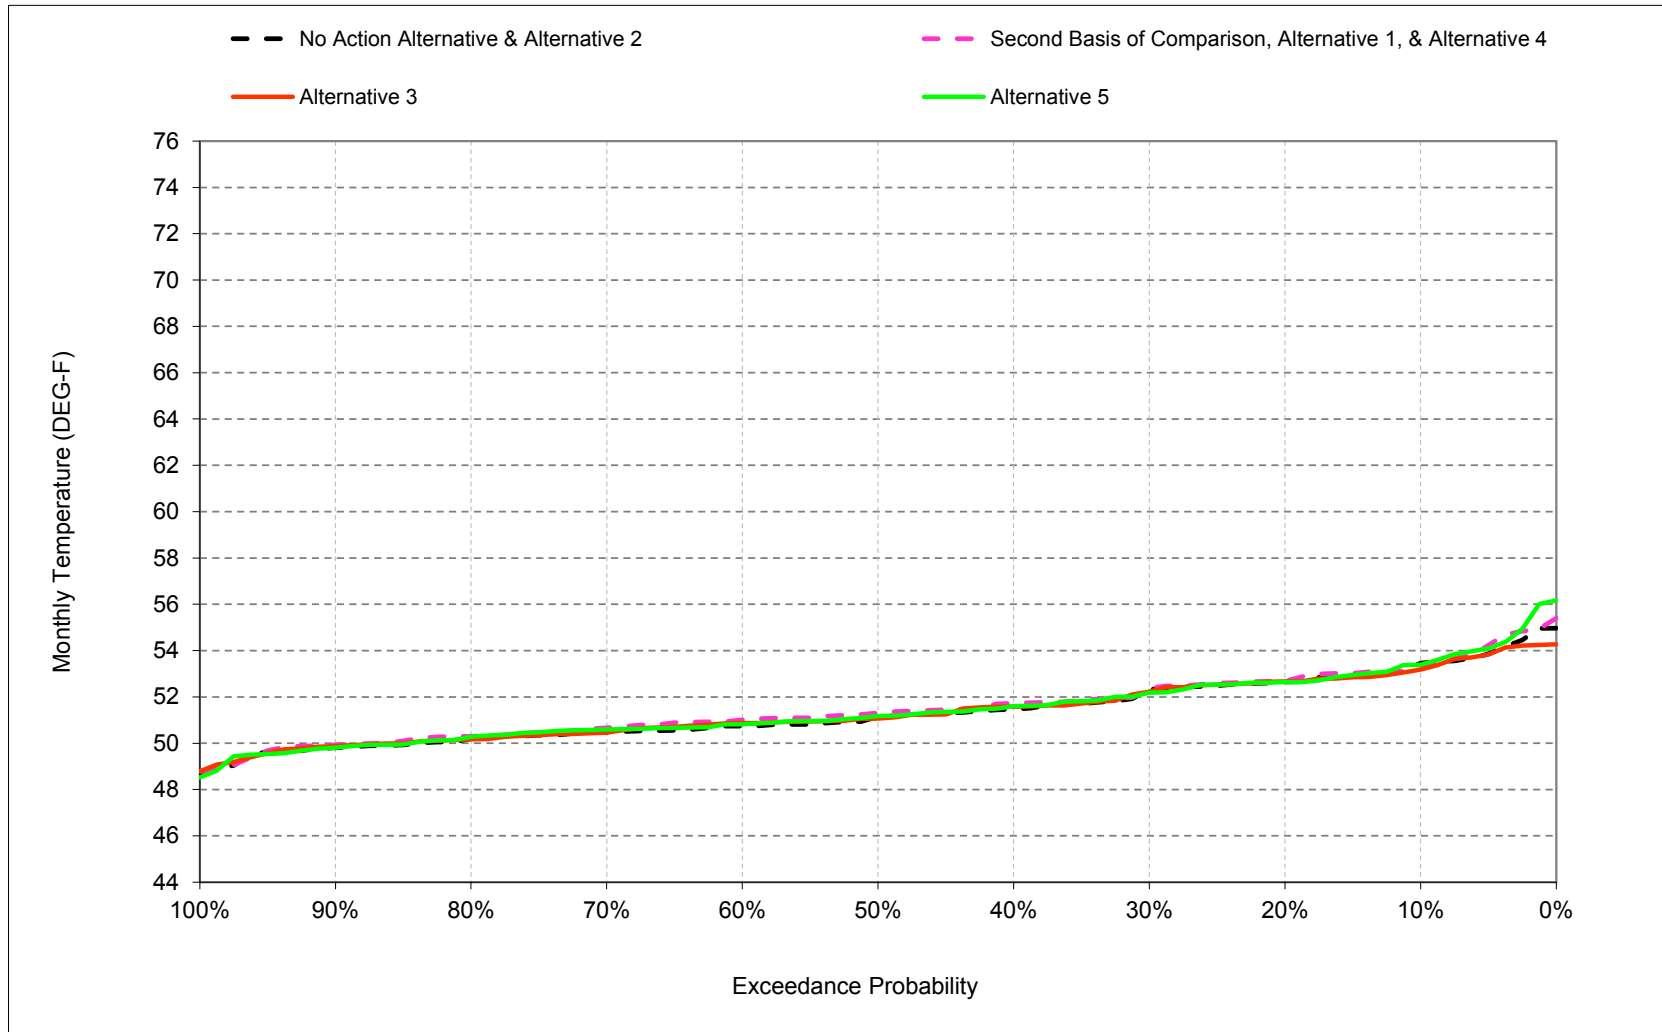


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-18-4. Stanislaus River at Orange Blossom Bridge, January

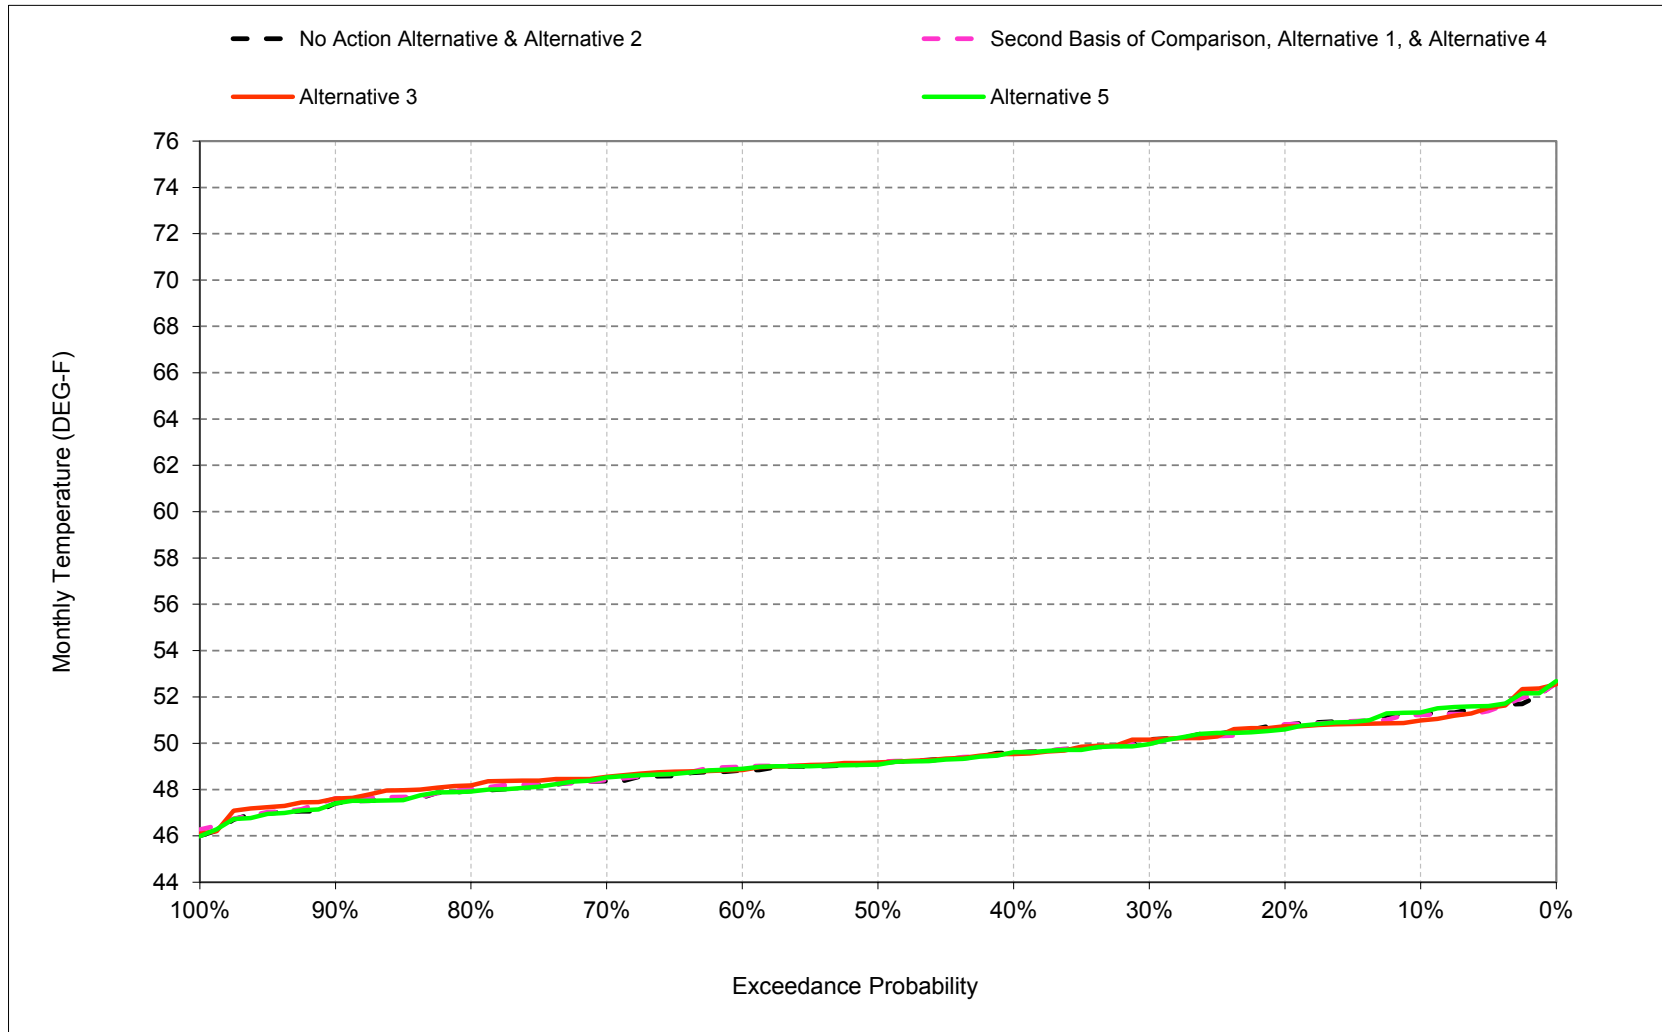


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-18-5. Stanislaus River at Orange Blossom Bridge, February

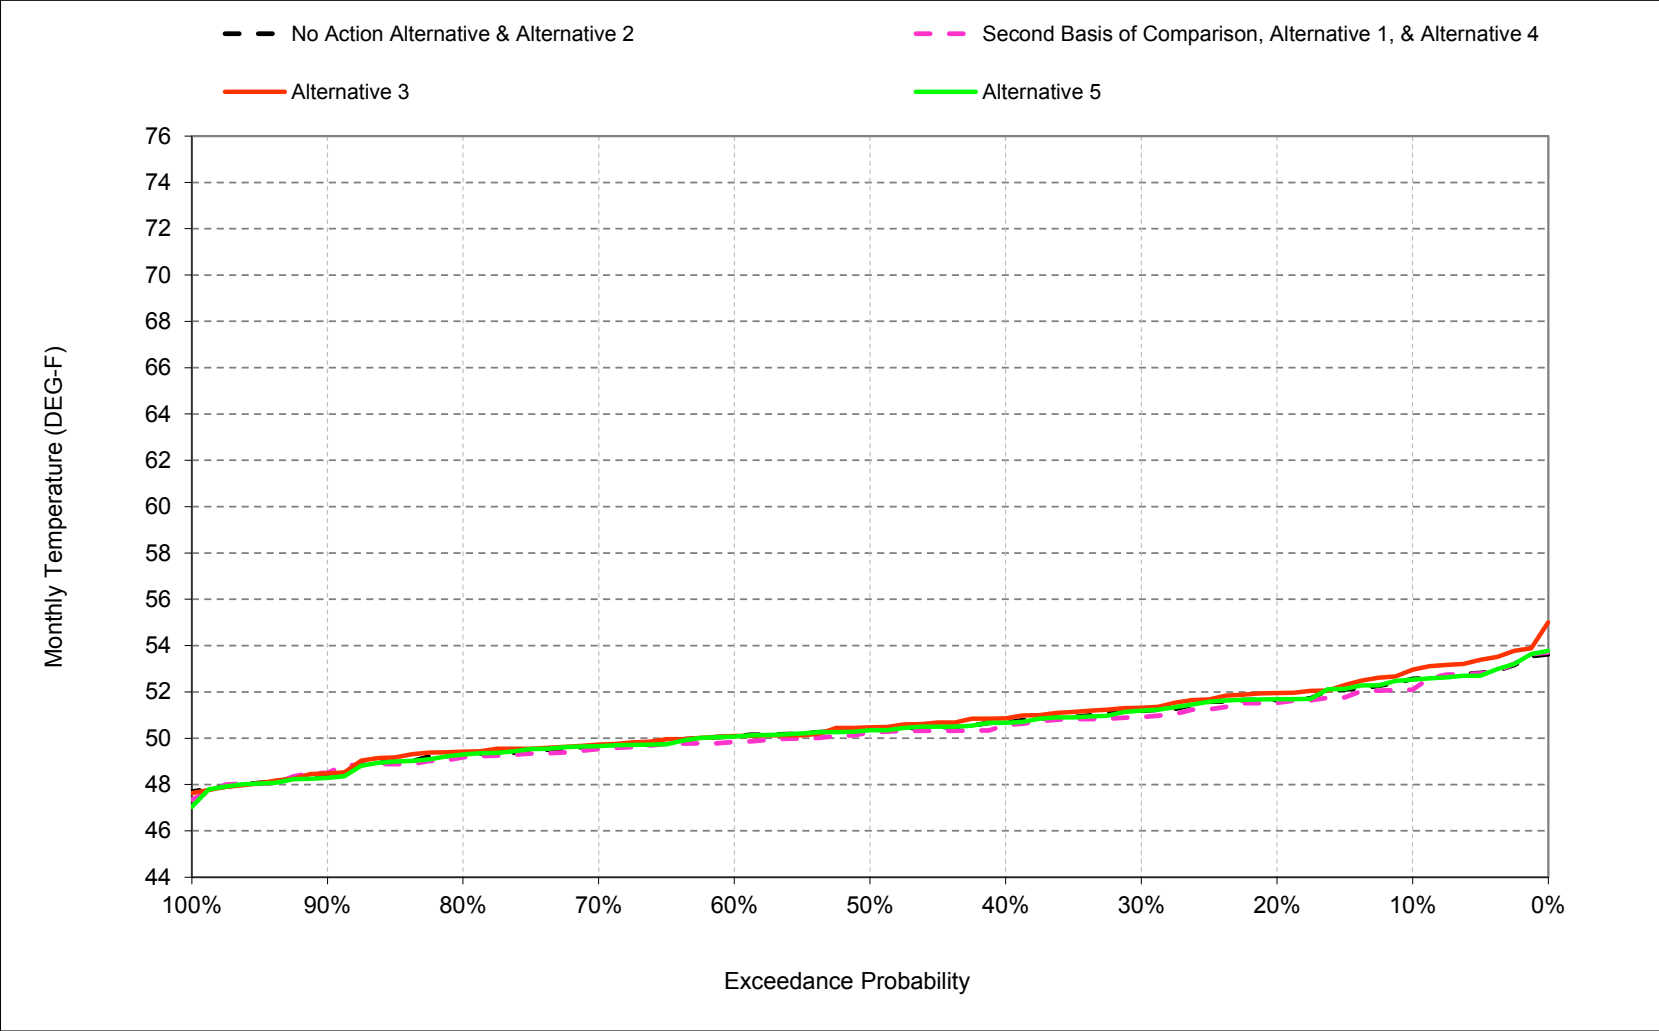


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-18-6. Stanislaus River at Orange Blossom Bridge, March

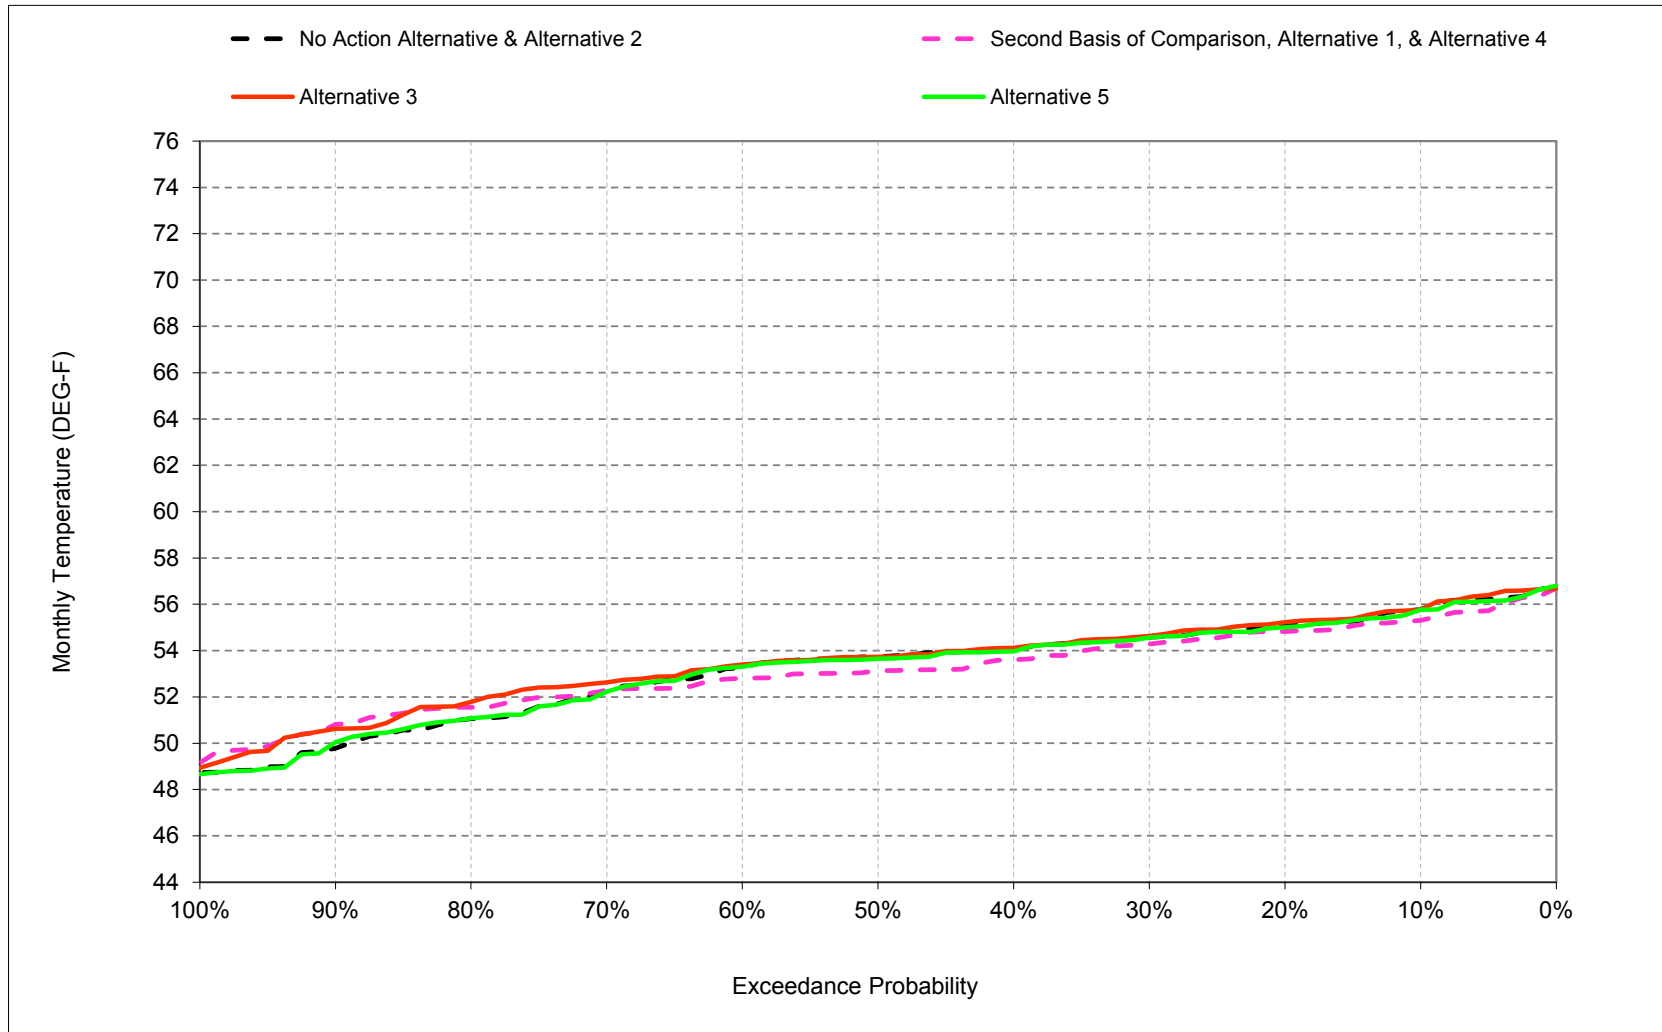


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-18-7. Stanislaus River at Orange Blossom Bridge, April

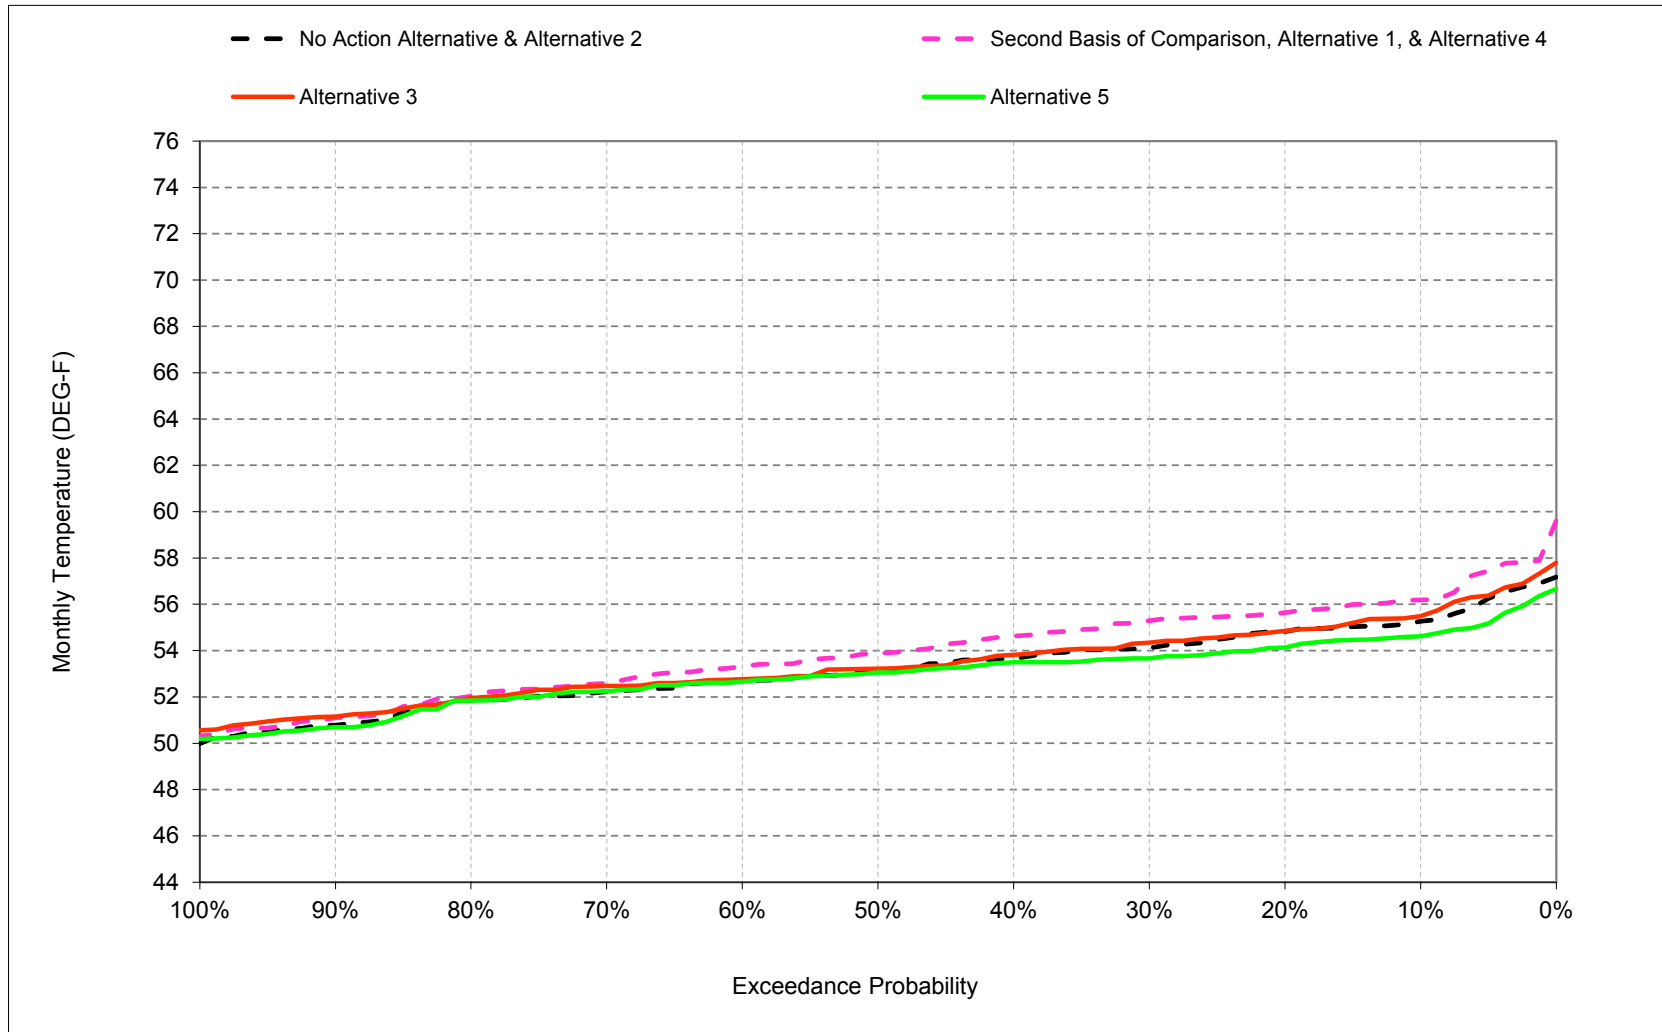


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-18-8. Stanislaus River at Orange Blossom Bridge, May

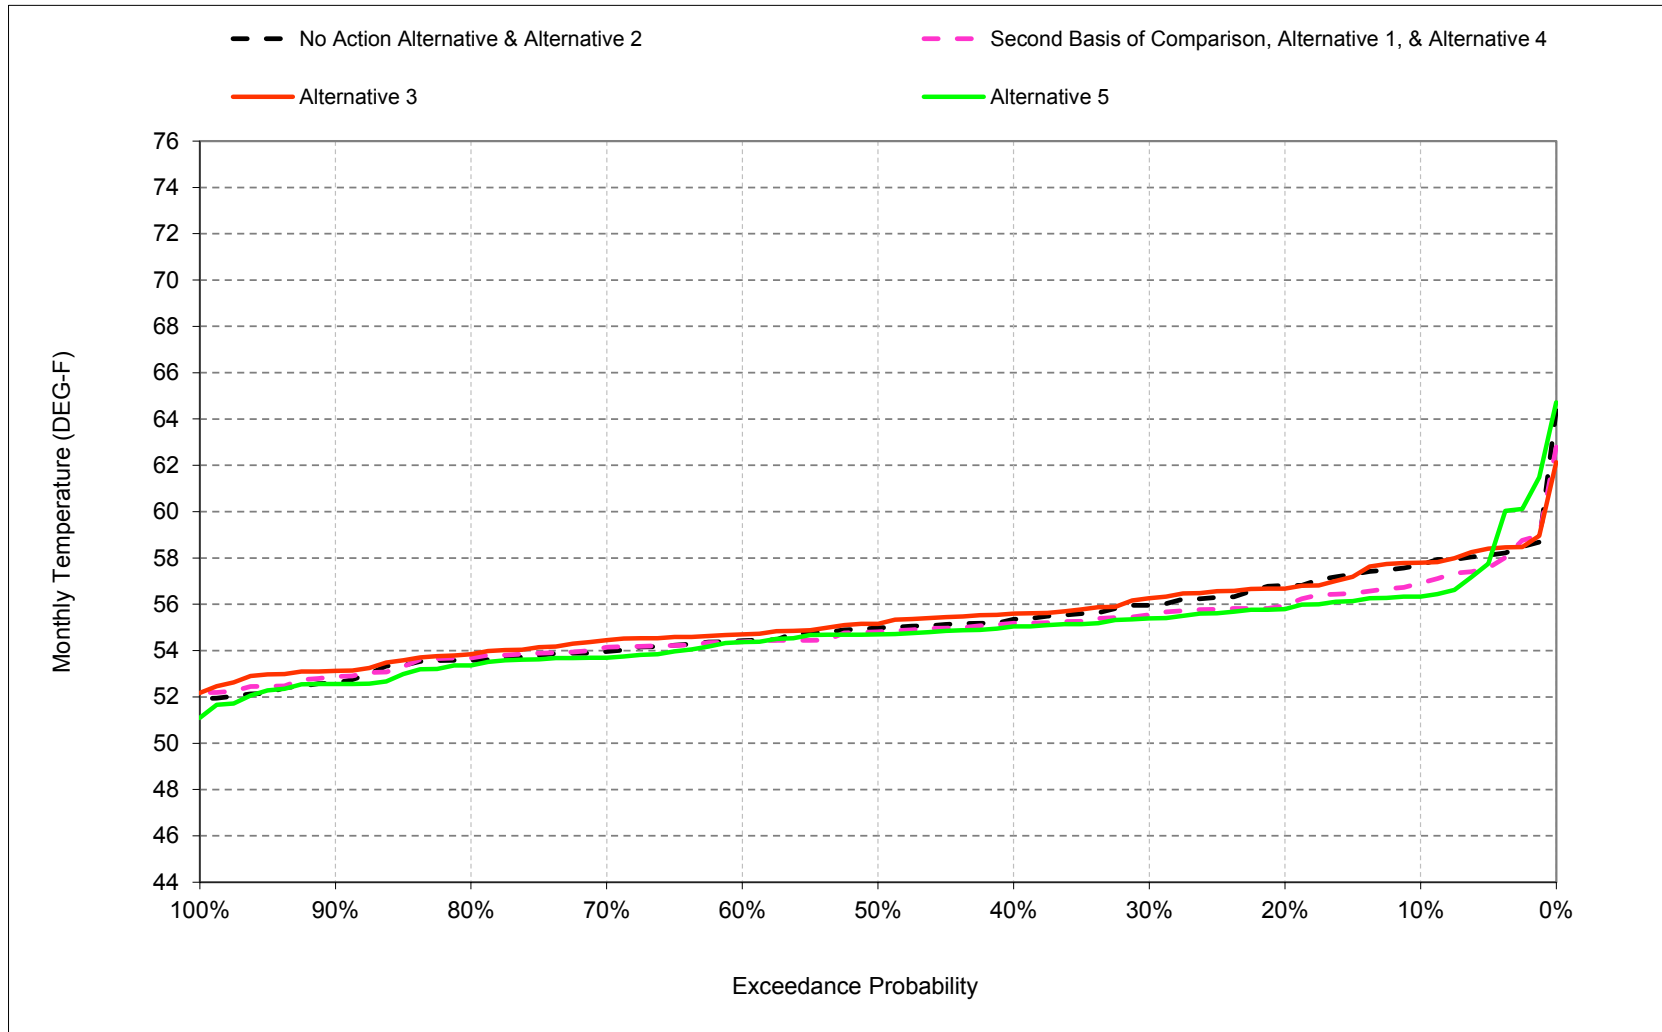


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-18-9. Stanislaus River at Orange Blossom Bridge, June

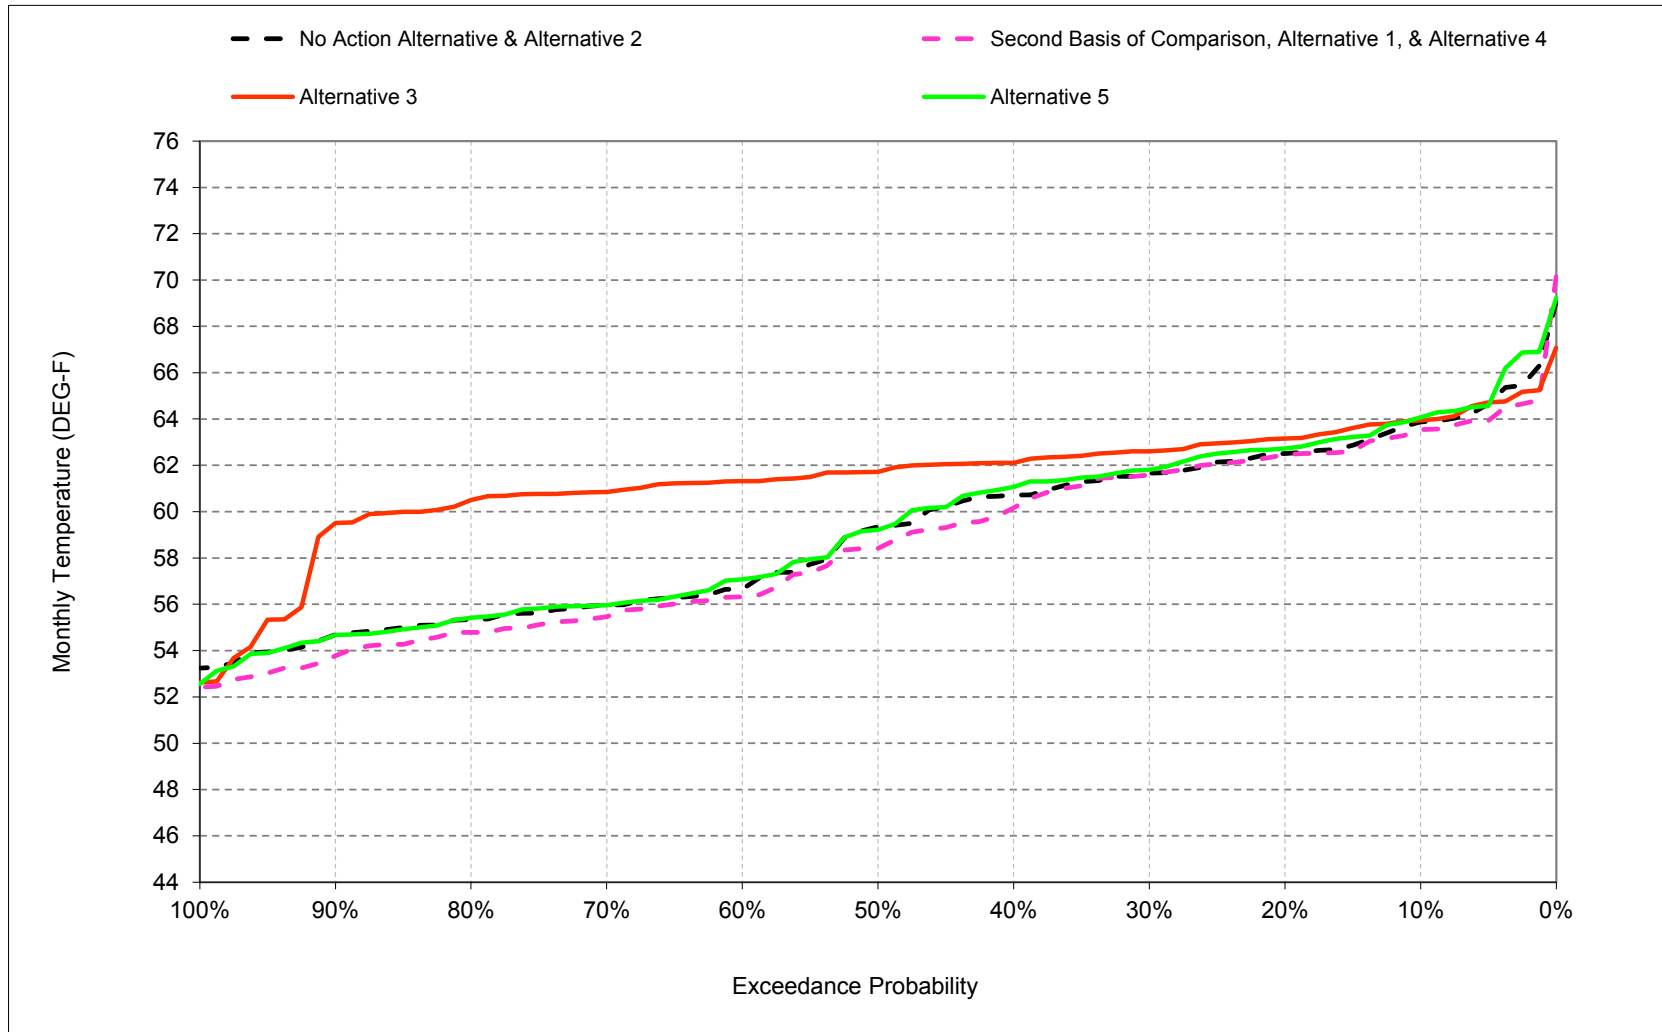


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-18-10. Stanislaus River at Orange Blossom Bridge, July

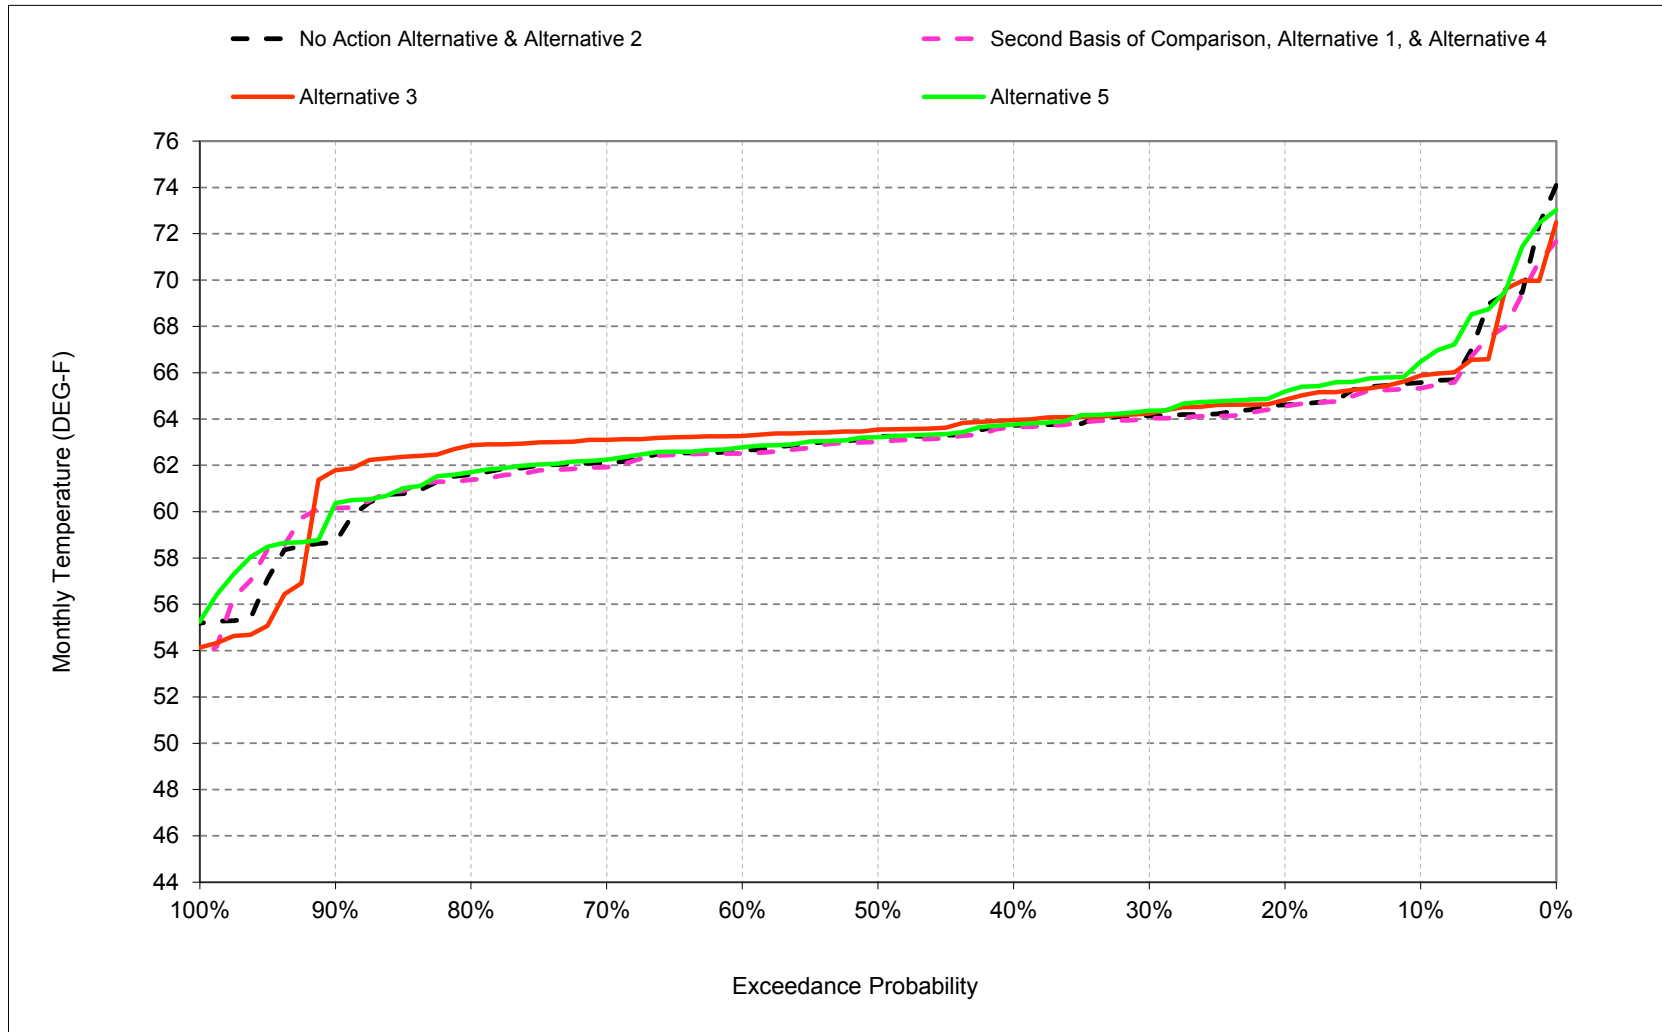


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-18-11. Stanislaus River at Orange Blossom Bridge, August

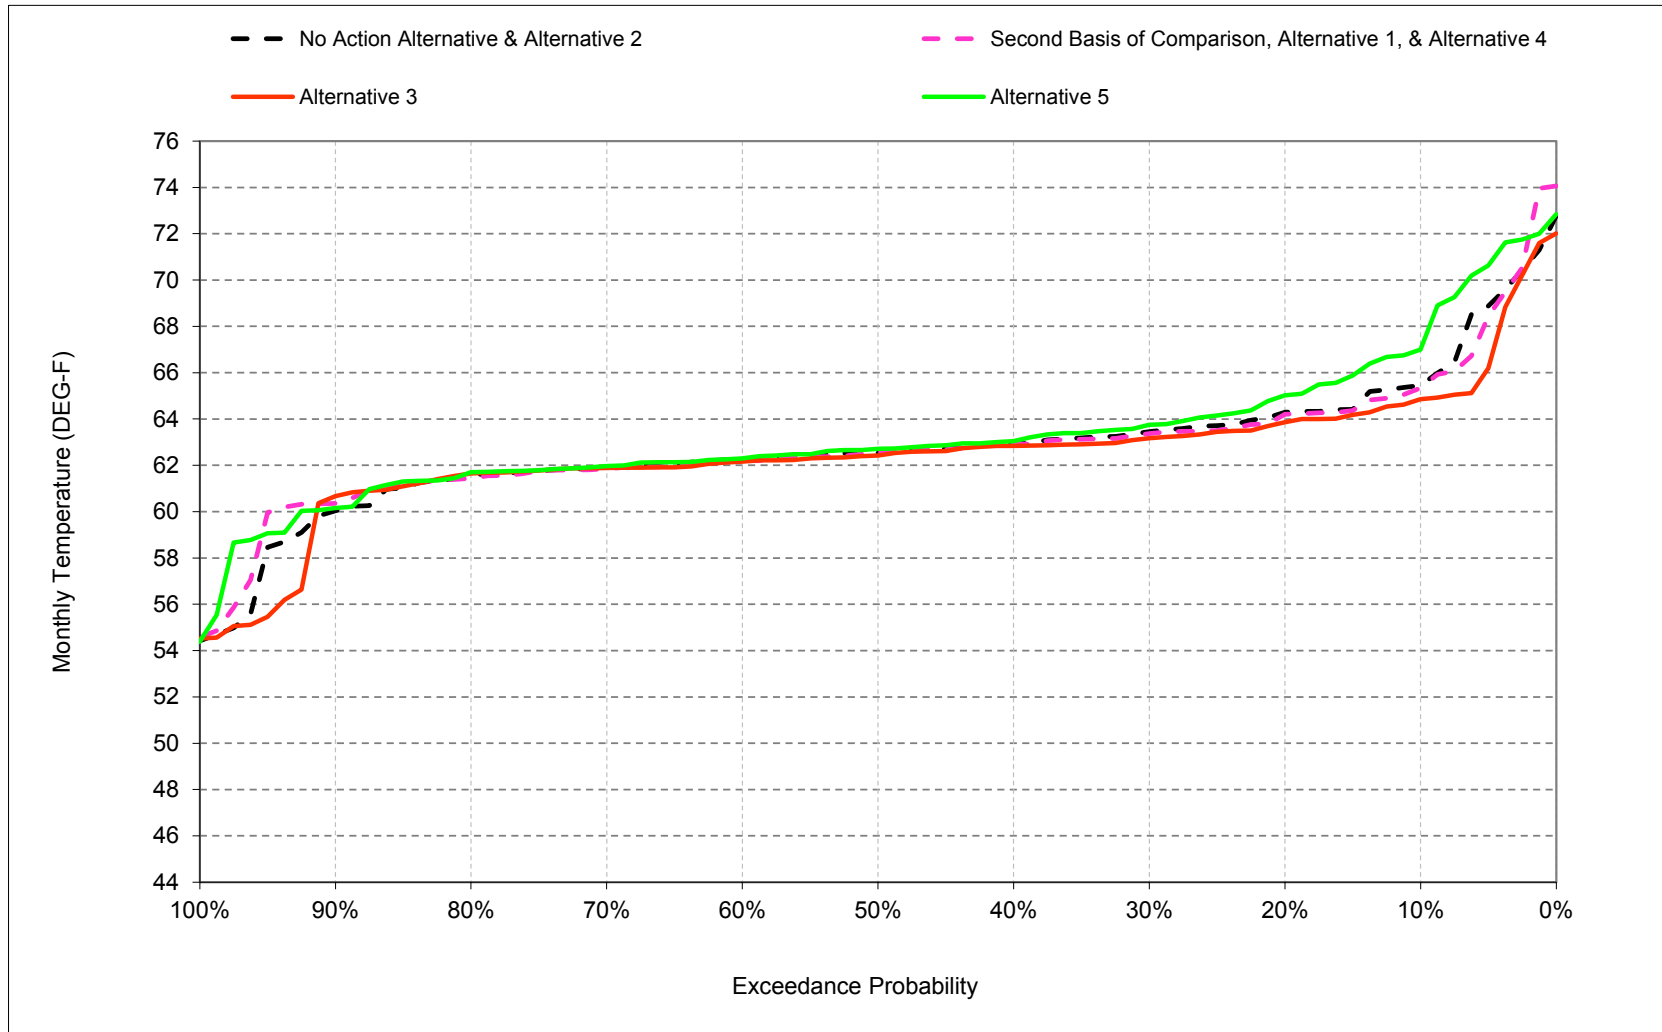

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-18-12. Stanislaus River at Orange Blossom Bridge, September

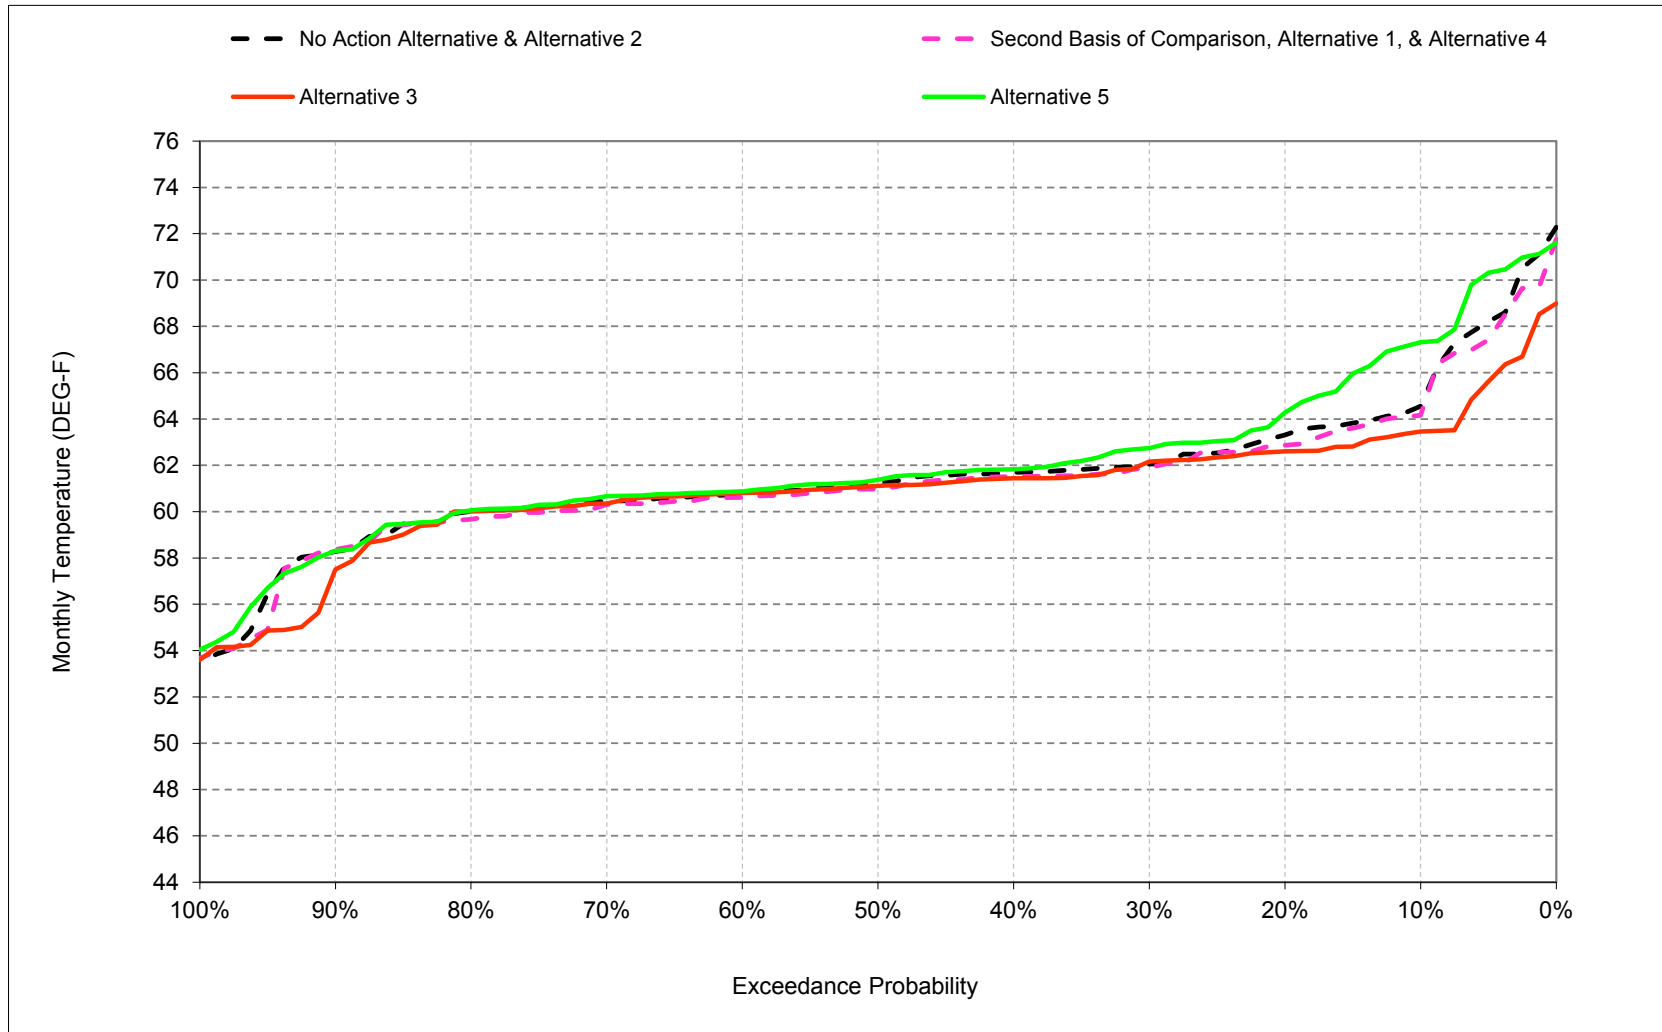

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-18-1. Stanislaus River at Orange Blossom Bridge, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	59	53	51	53	56	55	58	64	66	65	65
20%	59	57	53	51	52	55	55	57	63	65	64	63
30%	58	56	52	50	51	55	54	56	62	64	63	62
40%	57	55	51	50	51	54	54	55	61	64	63	62
50%	56	55	51	49	50	54	53	55	59	63	63	61
60%	56	55	51	49	50	53	53	54	57	63	62	61
70%	55	54	50	48	50	52	52	54	56	62	62	60
80%	55	54	50	48	49	51	52	54	55	62	61	60
90%	54	53	50	47	48	50	51	53	54	59	60	58
Long Term												
Full Simulation Period ^b	57	55	51	49	50	53	53	55	59	63	63	61
Water Year Types ^c												
Wet (32%)	54	52	49	49	49	51	52	53	55	60	60	59
Above Normal (16%)	57	56	52	50	51	54	53	55	58	63	62	61
Below Normal (13%)	57	55	51	49	50	54	53	55	59	63	63	61
Dry (24%)	57	55	51	49	51	55	54	56	61	64	63	62
Critical (15%)	61	58	53	50	52	55	55	58	64	67	68	67

Alternative 1												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	63	59	53	51	52	55	56	57	64	65	65	64
20%	61	57	53	51	52	55	56	56	62	65	64	63
30%	60	56	52	50	51	54	55	56	62	64	63	62
40%	59	55	52	50	50	54	55	55	60	64	63	62
50%	58	55	51	49	50	53	54	55	58	63	63	61
60%	58	54	51	49	50	53	53	54	56	63	62	61
70%	57	54	51	48	49	52	53	54	55	62	62	60
80%	56	53	50	48	49	52	52	54	55	61	61	60
90%	56	53	50	47	48	50	51	53	53	60	60	58
Long Term												
Full Simulation Period ^b	59	55	52	49	50	53	54	55	59	63	63	61
Water Year Types ^c												
Wet (32%)	55	52	49	49	49	51	52	53	54	60	60	58
Above Normal (16%)	59	56	52	50	51	53	53	54	58	62	62	61
Below Normal (13%)	58	54	51	49	50	53	54	55	59	63	63	61
Dry (24%)	59	55	51	49	51	54	55	56	61	64	63	62
Critical (15%)	63	58	53	50	52	55	56	58	63	67	68	66

Alternative 1 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	1.1	0.2	-0.1	0.0	-0.4	-0.5	0.9	-0.8	-0.3	-0.2	-0.1	-0.4
0.2	1.5	0.1	0.0	0.0	-0.1	-0.2	0.8	-0.9	-0.1	-0.1	-0.1	-0.4
0.3	2.5	-0.5	0.1	-0.1	-0.3	-0.3	1.2	-0.4	-0.1	-0.1	-0.1	-0.1
0.4	2.1	0.2	0.3	-0.1	-0.2	-0.4	1.0	-0.1	-0.7	-0.1	0.0	-0.2
0.5	1.9	-0.2	0.2	0.0	-0.1	-0.6	0.8	-0.2	-0.9	-0.2	0.0	-0.2
0.6	1.7	-0.1	0.3	0.2	-0.3	-0.4	0.6	0.0	-0.3	-0.1	0.0	-0.1
0.7	1.7	0.0	0.2	0.0	-0.1	0.1	0.4	0.1	-0.5	-0.2	0.0	-0.3
0.8	1.6	-0.2	0.1	0.1	-0.2	0.6	0.1	0.1	-0.5	-0.2	-0.1	-0.3
0.9	1.7	0.0	0.1	0.3	0.1	0.8	0.2	0.2	-1.0	1.5	0.5	0.1
Long Term												
Full Simulation Period ^b	1.6	-0.1	0.2	0.0	-0.1	-0.1	0.7	-0.2	-0.4	-0.1	0.1	-0.2
Water Year Types ^c												
Wet (32%)	1.4	-0.2	0.0	0.0	-0.1	0.5	0.2	0.1	-0.7	0.2	0.3	-0.1
Above Normal (16%)	1.8	-0.2	0.2	0.0	-0.2	-0.3	0.6	-0.2	-0.3	-0.1	-0.1	-0.2
Below Normal (13%)	1.4	-0.3	0.1	0.0	-0.3	-0.6	0.8	0.0	-0.6	-0.2	-0.1	-0.3
Dry (24%)	1.9	-0.1	0.2	0.1	-0.1	-0.5	1.2	-0.5	-0.1	-0.1	-0.1	-0.2
Critical (15%)	1.2	0.5	0.4	0.2	0.1	0.1	1.0	-0.7	-0.4	-0.7	0.1	-0.4

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on an 81-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-18-2. Stanislaus River at Orange Blossom Bridge, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	59	53	51	53	56	55	58	64	66	65	65
20%	59	57	53	51	52	55	55	57	63	65	64	63
30%	58	56	52	50	51	55	54	56	62	64	63	62
40%	57	55	51	50	51	54	54	55	61	64	63	62
50%	56	55	51	49	50	54	53	55	59	63	63	61
60%	56	55	51	49	50	53	53	54	57	63	62	61
70%	55	54	50	48	50	52	52	54	56	62	62	60
80%	55	54	50	48	49	51	52	54	55	62	61	60
90%	54	53	50	47	48	50	51	53	54	59	60	58
Long Term												
Full Simulation Period ^b	57	55	51	49	50	53	53	55	59	63	63	61
Water Year Types ^c												
Wet (32%)	54	52	49	49	49	51	52	53	55	60	60	59
Above Normal (16%)	57	56	52	50	51	54	53	55	58	63	62	61
Below Normal (13%)	57	55	51	49	50	54	53	55	59	63	63	61
Dry (24%)	57	55	51	49	51	55	54	56	61	64	63	62
Critical (15%)	61	58	53	50	52	55	55	58	64	67	68	67

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	58	53	51	53	56	55	58	64	66	65	63
20%	60	57	53	51	52	55	55	57	63	65	64	63
30%	59	55	52	50	51	55	54	56	63	64	63	62
40%	58	55	52	50	51	54	54	56	62	64	63	61
50%	58	54	51	49	50	54	53	55	62	63	62	61
60%	57	54	51	49	50	53	53	55	61	63	62	61
70%	57	54	50	48	50	53	52	54	61	63	62	60
80%	56	54	50	48	49	52	52	54	60	63	62	60
90%	55	53	50	47	48	51	51	53	59	61	60	56
Long Term												
Full Simulation Period ^b	58	55	51	49	51	53	53	55	61	63	62	61
Water Year Types ^c												
Wet (32%)	55	52	49	49	50	52	52	54	59	61	60	58
Above Normal (16%)	59	55	52	50	51	53	53	55	62	63	62	61
Below Normal (13%)	57	54	51	49	50	54	53	55	62	64	63	61
Dry (24%)	58	55	51	49	51	55	54	56	62	64	63	62
Critical (15%)	61	58	53	50	52	55	56	58	64	67	67	65

Alternative 3 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.3	-1.1	-0.3	-0.3	0.4	0.0	0.2	0.1	0.1	0.3	-0.6	-1.1
0.2	0.6	-0.4	0.0	-0.1	0.3	0.2	0.0	-0.1	0.6	0.2	-0.4	-0.7
0.3	1.6	-0.8	-0.1	0.1	0.1	0.0	0.2	0.3	1.0	0.1	-0.3	0.0
0.4	1.4	-0.2	0.1	0.0	0.2	0.1	0.2	0.3	1.4	0.2	-0.1	-0.2
0.5	1.5	-0.4	-0.1	0.0	0.1	0.0	0.2	0.2	2.4	0.3	-0.1	-0.1
0.6	1.6	-0.5	0.1	0.0	0.0	0.1	0.1	0.3	4.7	0.7	-0.1	0.0
0.7	1.6	-0.2	0.0	0.1	0.1	0.5	0.3	0.5	4.9	1.0	0.0	-0.1
0.8	1.5	-0.1	0.0	0.3	0.2	0.6	0.0	0.2	5.0	1.2	0.1	0.1
0.9	1.4	0.2	0.1	0.4	0.1	0.8	0.4	0.5	4.5	2.8	0.6	-2.3
Long Term												
Full Simulation Period ^b	1.1	-0.4	0.0	0.1	0.2	0.3	0.2	0.2	2.3	0.4	-0.3	-0.6
Water Year Types ^c												
Wet (32%)	1.1	-0.3	0.0	0.1	0.1	0.8	0.2	0.4	3.6	0.6	-0.2	-0.4
Above Normal (16%)	1.4	-0.4	0.0	0.2	0.0	-0.2	0.2	0.3	3.7	1.0	0.0	-0.1
Below Normal (13%)	0.9	-0.6	-0.2	0.0	-0.2	0.2	0.1	0.4	2.3	0.2	-0.2	-0.3
Dry (24%)	1.5	-0.3	0.1	0.0	0.3	0.1	0.2	0.3	1.1	0.2	-0.4	-0.6
Critical (15%)	-0.1	-0.2	0.2	0.1	0.6	0.3	0.1	-0.3	0.3	-0.4	-1.0	-2.1

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on an 81-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-18-3. Stanislaus River at Orange Blossom Bridge, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	59	53	51	53	56	55	58	64	66	65	65
20%	59	57	53	51	52	55	55	57	63	65	64	63
30%	58	56	52	50	51	55	54	56	62	64	63	62
40%	57	55	51	50	51	54	54	55	61	64	63	62
50%	56	55	51	49	50	54	53	55	59	63	63	61
60%	56	55	51	49	50	53	53	54	57	63	62	61
70%	55	54	50	48	50	52	52	54	56	62	62	60
80%	55	54	50	48	49	51	52	54	55	62	61	60
90%	54	53	50	47	48	50	51	53	54	59	60	58
Long Term												
Full Simulation Period ^b	57	55	51	49	50	53	53	55	59	63	63	61
Water Year Types ^c												
Wet (32%)	54	52	49	49	49	51	52	53	55	60	60	59
Above Normal (16%)	57	56	52	50	51	54	53	55	58	63	62	61
Below Normal (13%)	57	55	51	49	50	54	53	55	59	63	63	61
Dry (24%)	57	55	51	49	51	55	54	56	61	64	63	62
Critical (15%)	61	58	53	50	52	55	55	58	64	67	68	67

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	65	60	53	51	53	56	55	56	64	66	67	67
20%	60	58	53	51	52	55	54	56	63	65	65	64
30%	58	56	52	50	51	55	54	55	62	64	64	63
40%	57	55	52	50	51	54	53	55	61	64	63	62
50%	57	55	51	49	50	54	53	55	59	63	63	61
60%	56	55	51	49	50	53	53	54	57	63	62	61
70%	55	54	51	48	50	52	52	54	56	62	62	61
80%	55	54	50	48	49	51	52	53	55	62	61	60
90%	54	53	50	47	48	50	51	53	54	59	60	58
Long Term												
Full Simulation Period ^b	58	56	51	49	50	53	53	55	59	63	63	62
Water Year Types ^c												
Wet (32%)	54	53	49	49	49	51	51	53	55	60	61	59
Above Normal (16%)	58	56	52	50	51	54	53	54	58	63	62	61
Below Normal (13%)	57	55	51	49	50	54	53	55	60	64	63	62
Dry (24%)	58	56	51	49	51	55	54	55	62	64	64	63
Critical (15%)	62	58	53	50	52	55	55	58	64	68	68	67

Alternative 5 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	3.4	0.9	-0.1	0.1	0.0	0.0	-0.6	-1.4	0.2	0.8	1.5	2.8
0.2	0.7	1.0	0.0	-0.2	0.0	-0.1	-0.7	-1.0	0.2	0.5	0.7	0.9
0.3	0.5	0.3	-0.1	-0.2	0.0	0.0	-0.4	-0.6	0.2	0.2	0.3	0.7
0.4	0.3	0.2	0.1	0.0	0.0	-0.1	-0.2	-0.3	0.3	0.0	0.1	0.2
0.5	0.1	0.1	0.0	0.0	0.0	-0.1	0.0	-0.3	-0.1	0.0	0.1	0.1
0.6	0.1	0.1	0.1	0.1	0.0	0.0	0.0	-0.1	0.4	0.1	0.0	0.1
0.7	0.2	0.2	0.1	0.1	0.0	-0.1	0.1	-0.2	0.0	0.1	0.1	0.1
0.8	0.1	0.1	0.1	0.0	0.0	0.0	0.0	-0.2	0.0	0.1	0.0	0.0
0.9	0.0	0.3	0.0	0.1	-0.1	0.0	-0.1	0.0	0.0	0.3	0.2	-0.1
Long Term												
Full Simulation Period ^b	0.6	0.3	0.1	0.0	0.0	0.0	-0.3	-0.3	0.2	0.3	0.5	0.5
Water Year Types ^c												
Wet (32%)	0.6	0.3	0.1	0.0	-0.1	0.0	0.0	-0.2	0.0	0.5	0.5	0.2
Above Normal (16%)	0.4	0.3	0.1	0.1	0.0	0.0	-0.2	-0.4	-0.1	0.1	0.1	0.2
Below Normal (13%)	0.7	0.0	0.0	0.0	0.0	-0.1	-0.2	-0.2	0.5	0.3	0.4	0.5
Dry (24%)	0.6	0.4	0.2	0.1	0.0	0.0	-0.5	-0.6	0.2	0.3	0.7	1.1
Critical (15%)	0.4	0.6	0.0	-0.2	-0.1	-0.1	-0.6	-0.2	0.5	0.5	0.9	0.4

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-18-4. Stanislaus River at Orange Blossom Bridge, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	63	59	53	51	52	55	56	57	64	65	65	64
20%	61	57	53	51	52	55	56	56	62	65	64	63
30%	60	56	52	50	51	54	55	56	62	64	63	62
40%	59	55	52	50	50	54	55	55	60	64	63	62
50%	58	55	51	49	50	53	54	55	58	63	63	61
60%	58	54	51	49	50	53	53	54	56	63	62	61
70%	57	54	51	48	49	52	53	54	55	62	62	60
80%	56	53	50	48	49	52	52	54	55	61	61	60
90%	56	53	50	47	48	50	51	53	53	60	60	58
Long Term												
Full Simulation Period ^b	59	55	52	49	50	53	54	55	59	63	63	61
Water Year Types ^c												
Wet (32%)	55	52	49	49	49	51	52	53	54	60	60	58
Above Normal (16%)	59	56	52	50	51	53	53	54	58	62	62	61
Below Normal (13%)	58	54	51	49	50	53	54	55	59	63	63	61
Dry (24%)	59	55	51	49	51	54	55	56	61	64	63	62
Critical (15%)	63	58	53	50	52	55	56	58	63	67	68	66

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	59	53	51	53	56	55	58	64	66	65	65
20%	59	57	53	51	52	55	55	57	63	65	64	63
30%	58	56	52	50	51	55	54	56	62	64	63	62
40%	57	55	51	50	51	54	54	55	61	64	63	62
50%	56	55	51	49	50	54	53	55	59	63	63	61
60%	56	55	51	49	50	53	53	54	57	63	62	61
70%	55	54	50	48	50	52	52	54	56	62	62	60
80%	55	54	50	48	49	51	52	54	55	62	61	60
90%	54	53	50	47	48	50	51	53	54	59	60	58
Long Term												
Full Simulation Period ^b	57	55	51	49	50	53	53	55	59	63	63	61
Water Year Types ^c												
Wet (32%)	54	52	49	49	49	51	52	53	55	60	60	59
Above Normal (16%)	57	56	52	50	51	54	53	55	58	63	62	61
Below Normal (13%)	57	55	51	49	50	54	53	55	59	63	63	61
Dry (24%)	57	55	51	49	51	55	54	56	61	64	63	62
Critical (15%)	61	58	53	50	52	55	55	58	64	67	68	67

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-1.1	-0.2	0.1	0.0	0.4	0.5	-0.9	0.8	0.3	0.2	0.1	0.4
0.2	-1.5	-0.1	0.0	0.0	0.1	0.2	-0.8	0.9	0.1	0.1	0.1	0.4
0.3	-2.5	0.5	-0.1	0.1	0.3	0.3	-1.2	0.4	0.1	0.1	0.1	0.1
0.4	-2.1	-0.2	-0.3	0.1	0.2	0.4	-1.0	0.1	0.7	0.1	0.0	0.2
0.5	-1.9	0.2	-0.2	0.0	0.1	0.6	-0.8	0.2	0.9	0.2	0.0	0.2
0.6	-1.7	0.1	-0.3	-0.2	0.3	0.4	-0.6	0.0	0.3	0.1	0.0	0.1
0.7	-1.7	0.0	-0.2	0.0	0.1	-0.1	-0.4	-0.1	0.5	0.2	0.0	0.3
0.8	-1.6	0.2	-0.1	-0.1	0.2	-0.6	-0.1	-0.1	0.5	0.2	0.1	0.3
0.9	-1.7	0.0	-0.1	-0.3	-0.1	-0.8	-0.2	-0.2	1.0	-1.5	-0.5	-0.1
Long Term												
Full Simulation Period ^b	-1.6	0.1	-0.2	0.0	0.1	0.1	-0.7	0.2	0.4	0.1	-0.1	0.2
Water Year Types ^c												
Wet (32%)	-1.4	0.2	0.0	0.0	0.1	-0.5	-0.2	-0.1	0.7	-0.2	-0.3	0.1
Above Normal (16%)	-1.8	0.2	-0.2	0.0	0.2	0.3	-0.6	0.2	0.3	0.1	0.1	0.2
Below Normal (13%)	-1.4	0.3	-0.1	0.0	0.3	0.6	-0.8	0.0	0.6	0.2	0.1	0.3
Dry (24%)	-1.9	0.1	-0.2	-0.1	0.1	0.5	-1.2	0.5	0.1	0.1	0.1	0.2
Critical (15%)	-1.2	-0.5	-0.4	-0.2	-0.1	-0.1	-1.0	0.7	0.4	0.7	-0.1	0.4

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-18-5. Stanislaus River at Orange Blossom Bridge, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	63	59	53	51	52	55	56	57	64	65	65	64
20%	61	57	53	51	52	55	56	56	62	65	64	63
30%	60	56	52	50	51	54	55	56	62	64	63	62
40%	59	55	52	50	50	54	55	55	60	64	63	62
50%	58	55	51	49	50	53	54	55	58	63	63	61
60%	58	54	51	49	50	53	53	54	56	63	62	61
70%	57	54	51	48	49	52	53	54	55	62	62	60
80%	56	53	50	48	49	52	52	54	55	61	61	60
90%	56	53	50	47	48	50	51	53	53	60	60	58
Long Term												
Full Simulation Period ^b	59	55	52	49	50	53	54	55	59	63	63	61
Water Year Types ^c												
Wet (32%)	55	52	49	49	49	51	52	53	54	60	60	58
Above Normal (16%)	59	56	52	50	51	53	53	54	58	62	62	61
Below Normal (13%)	58	54	51	49	50	53	54	55	59	63	63	61
Dry (24%)	59	55	51	49	51	54	55	56	61	64	63	62
Critical (15%)	63	58	53	50	52	55	56	58	63	67	68	66

Alternative 3

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	61	58	53	51	53	56	55	58	64	66	65	63
20%	60	57	53	51	52	55	55	57	63	65	64	63
30%	59	55	52	50	51	55	54	56	63	64	63	62
40%	58	55	52	50	51	54	54	56	62	64	63	61
50%	58	54	51	49	50	54	53	55	62	63	62	61
60%	57	54	51	49	50	53	53	55	61	63	62	61
70%	57	54	50	48	50	53	52	54	61	63	62	60
80%	56	54	50	48	49	52	52	54	60	63	62	60
90%	55	53	50	47	48	51	51	53	59	61	60	56
Long Term												
Full Simulation Period ^b	58	55	51	49	51	53	53	55	61	63	62	61
Water Year Types ^c												
Wet (32%)	55	52	49	49	50	52	52	54	59	61	60	58
Above Normal (16%)	59	55	52	50	51	53	53	55	62	63	62	61
Below Normal (13%)	57	54	51	49	50	54	53	55	62	64	63	61
Dry (24%)	58	55	51	49	51	55	54	56	62	64	63	62
Critical (15%)	61	58	53	50	52	55	56	58	64	67	67	65

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-1.4	-1.4	-0.2	-0.3	0.8	0.5	-0.7	0.9	0.4	0.5	-0.5	-0.7
0.2	-0.8	-0.5	0.0	-0.1	0.4	0.4	-0.8	0.8	0.7	0.3	-0.3	-0.3
0.3	-0.9	-0.3	-0.2	0.2	0.4	0.3	-0.9	0.7	1.0	0.2	-0.2	0.2
0.4	-0.7	-0.4	-0.1	0.0	0.4	0.5	-0.8	0.4	2.1	0.3	-0.1	-0.1
0.5	-0.4	-0.2	-0.2	0.0	0.3	0.6	-0.6	0.4	3.3	0.5	-0.1	0.1
0.6	-0.2	-0.3	-0.1	-0.1	0.3	0.6	-0.5	0.3	5.0	0.7	-0.1	0.2
0.7	-0.1	-0.2	-0.2	0.1	0.2	0.4	-0.1	0.4	5.4	1.2	0.1	0.2
0.8	-0.1	0.1	-0.1	0.2	0.3	0.1	-0.1	0.1	5.5	1.4	0.2	0.4
0.9	-0.3	0.3	-0.1	0.1	0.0	0.1	0.3	0.3	5.5	1.3	0.1	-2.4
Long Term												
Full Simulation Period ^b	-0.5	-0.3	-0.1	0.1	0.3	0.4	-0.5	0.4	2.8	0.5	-0.4	-0.4
Water Year Types ^c												
Wet (32%)	-0.3	-0.1	-0.1	0.1	0.3	0.3	0.0	0.2	4.3	0.4	-0.5	-0.3
Above Normal (16%)	-0.4	-0.3	-0.2	0.2	0.2	0.1	-0.4	0.5	4.0	1.1	0.0	0.1
Below Normal (13%)	-0.4	-0.3	-0.2	0.0	0.1	0.7	-0.6	0.4	2.9	0.4	-0.1	0.1
Dry (24%)	-0.4	-0.2	-0.1	0.0	0.4	0.5	-1.0	0.7	1.2	0.3	-0.3	-0.4
Critical (15%)	-1.2	-0.7	-0.3	-0.1	0.5	0.2	-0.9	0.3	0.7	0.2	-1.1	-1.6

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-18-6. Stanislaus River at Orange Blossom Bridge, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	63	59	53	51	52	55	56	57	64	65	65	64
20%	61	57	53	51	52	55	56	56	62	65	64	63
30%	60	56	52	50	51	54	55	56	62	64	63	62
40%	59	55	52	50	50	54	55	55	60	64	63	62
50%	58	55	51	49	50	53	54	55	58	63	63	61
60%	58	54	51	49	50	53	53	54	56	63	62	61
70%	57	54	51	48	49	52	53	54	55	62	62	60
80%	56	53	50	48	49	52	52	54	55	61	61	60
90%	56	53	50	47	48	50	51	53	53	60	60	58
Long Term												
Full Simulation Period ^b	59	55	52	49	50	53	54	55	59	63	63	61
Water Year Types ^c												
Wet (32%)	55	52	49	49	49	51	52	53	54	60	60	58
Above Normal (16%)	59	56	52	50	51	53	53	54	58	62	62	61
Below Normal (13%)	58	54	51	49	50	53	54	55	59	63	63	61
Dry (24%)	59	55	51	49	51	54	55	56	61	64	63	62
Critical (15%)	63	58	53	50	52	55	56	58	63	67	68	66

Alternative 5

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	65	60	53	51	53	56	55	56	64	66	67	67
20%	60	58	53	51	52	55	54	56	63	65	65	64
30%	58	56	52	50	51	55	54	55	62	64	64	63
40%	57	55	52	50	51	54	53	55	61	64	63	62
50%	57	55	51	49	50	54	53	55	59	63	63	61
60%	56	55	51	49	50	53	53	54	57	63	62	61
70%	55	54	51	48	50	52	52	54	56	62	62	61
80%	55	54	50	48	49	51	52	53	55	62	61	60
90%	54	53	50	47	48	50	51	53	54	59	60	58
Long Term												
Full Simulation Period ^b	58	56	51	49	50	53	53	55	59	63	63	62
Water Year Types ^c												
Wet (32%)	54	53	49	49	49	51	51	53	55	60	61	59
Above Normal (16%)	58	56	52	50	51	54	53	54	58	63	62	61
Below Normal (13%)	57	55	51	49	50	54	53	55	60	64	63	62
Dry (24%)	58	56	51	49	51	55	54	55	62	64	64	63
Critical (15%)	62	58	53	50	52	55	55	58	64	68	68	67

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	2.3	0.7	0.0	0.1	0.4	0.4	-1.6	-0.6	0.5	1.1	1.7	3.1
0.2	-0.8	0.9	0.0	-0.2	0.2	0.2	-1.5	-0.1	0.3	0.6	0.8	1.3
0.3	-2.0	0.8	-0.2	0.0	0.3	0.3	-1.6	-0.1	0.2	0.3	0.4	0.8
0.4	-1.8	0.1	-0.1	0.0	0.2	0.4	-1.1	-0.2	1.0	0.1	0.1	0.3
0.5	-1.8	0.3	-0.1	-0.1	0.1	0.5	-0.8	-0.1	0.8	0.2	0.2	0.3
0.6	-1.7	0.2	-0.2	-0.1	0.2	0.5	-0.6	0.0	0.7	0.2	0.1	0.3
0.7	-1.5	0.2	-0.1	0.1	0.2	-0.2	-0.3	-0.4	0.5	0.3	0.1	0.4
0.8	-1.5	0.3	0.0	-0.1	0.2	-0.6	-0.1	-0.3	0.6	0.3	0.1	0.3
0.9	-1.7	0.4	-0.1	-0.2	-0.2	-0.9	-0.3	-0.2	0.9	-1.2	-0.3	-0.2
Long Term												
Full Simulation Period ^b	-1.0	0.4	-0.1	0.0	0.1	0.0	-0.9	-0.1	0.6	0.4	0.5	0.7
Water Year Types ^c												
Wet (32%)	-0.8	0.5	0.1	0.0	0.1	-0.4	-0.2	-0.4	0.8	0.3	0.2	0.3
Above Normal (16%)	-1.4	0.5	0.0	0.1	0.2	0.3	-0.8	-0.2	0.2	0.2	0.2	0.4
Below Normal (13%)	-0.7	0.4	0.0	0.0	0.3	0.5	-0.9	-0.2	1.0	0.4	0.5	0.8
Dry (24%)	-1.3	0.5	0.0	0.0	0.2	0.4	-1.6	-0.1	0.2	0.4	0.8	1.3
Critical (15%)	-0.8	0.1	-0.5	-0.3	-0.2	-0.2	-1.5	0.5	0.9	1.1	0.8	0.8

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


B.19. Stanislaus River at Mouth Temperature

Figure B-19-1. Stanislaus River at Mouth, October

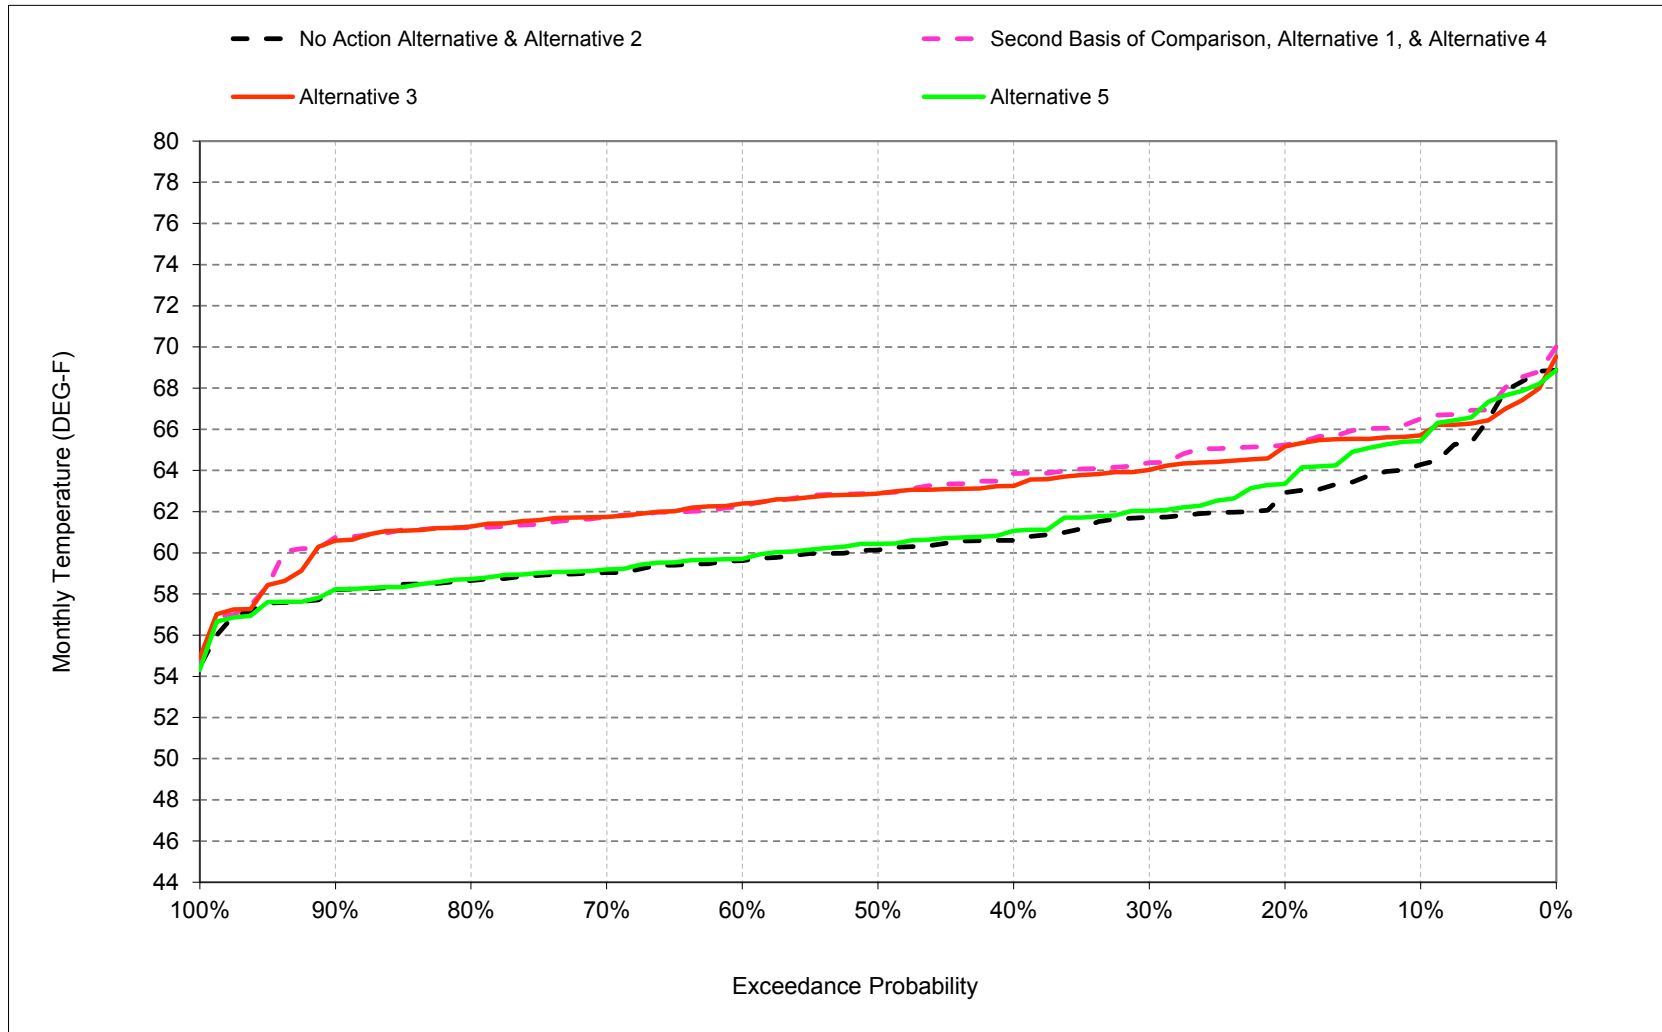


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-19-2. Stanislaus River at Mouth, November

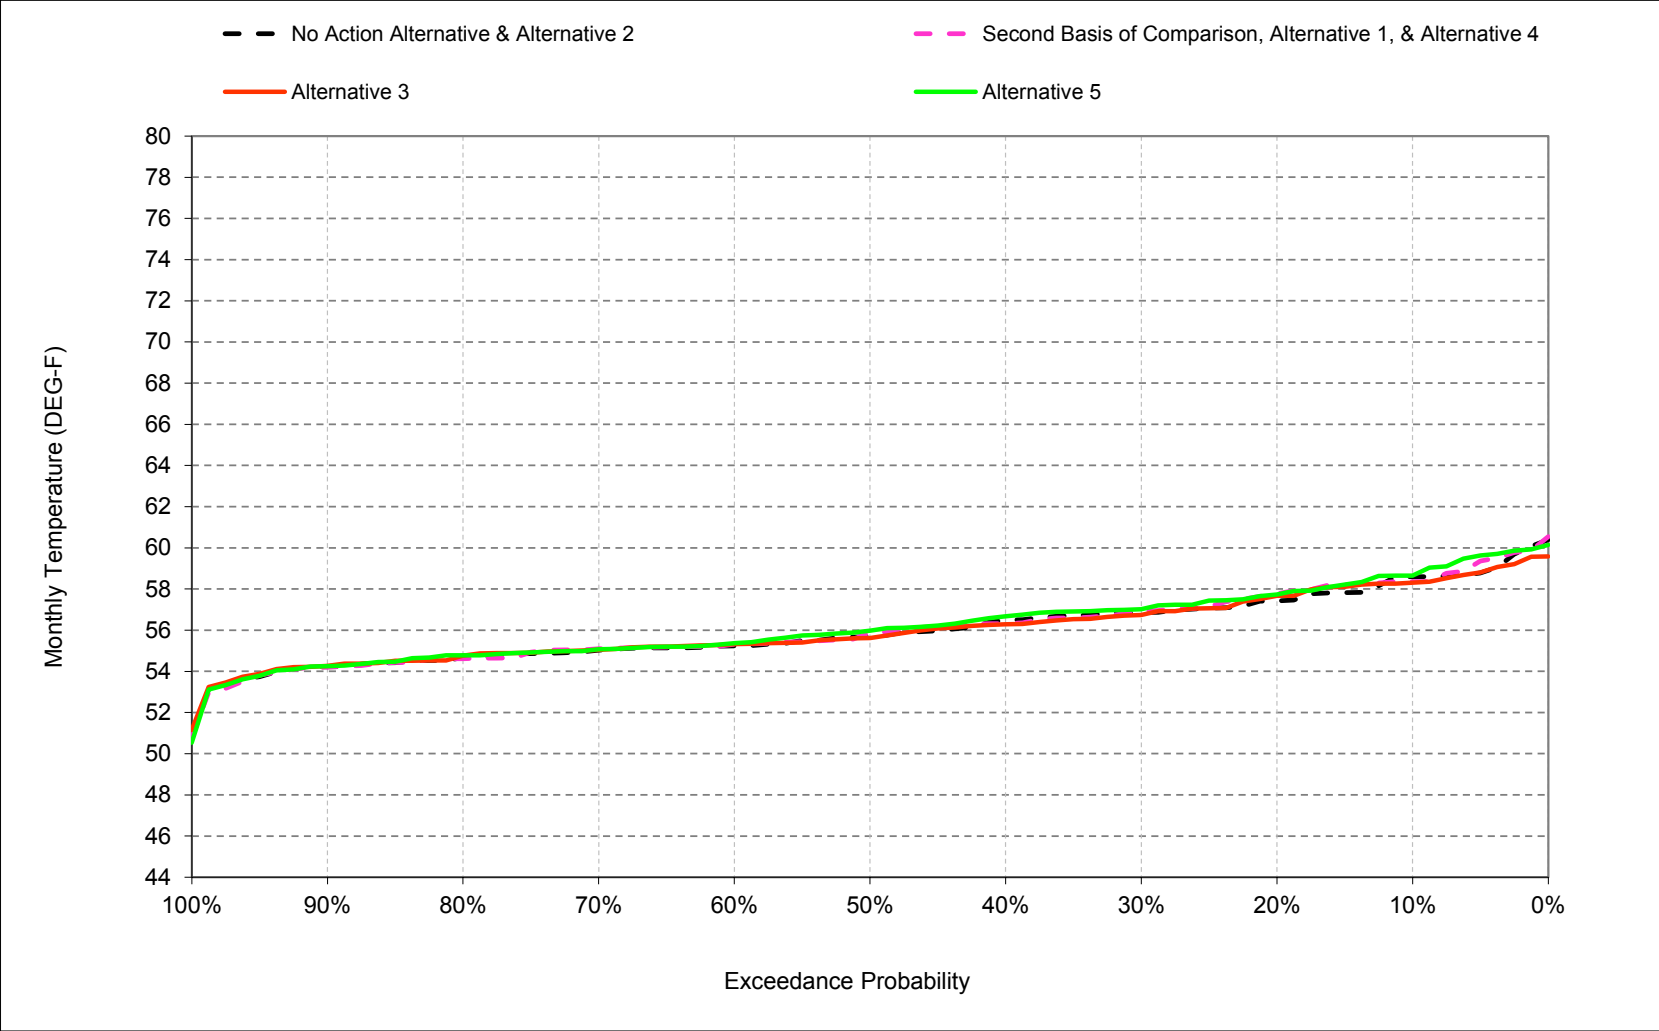


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-19-3. Stanislaus River at Mouth, December

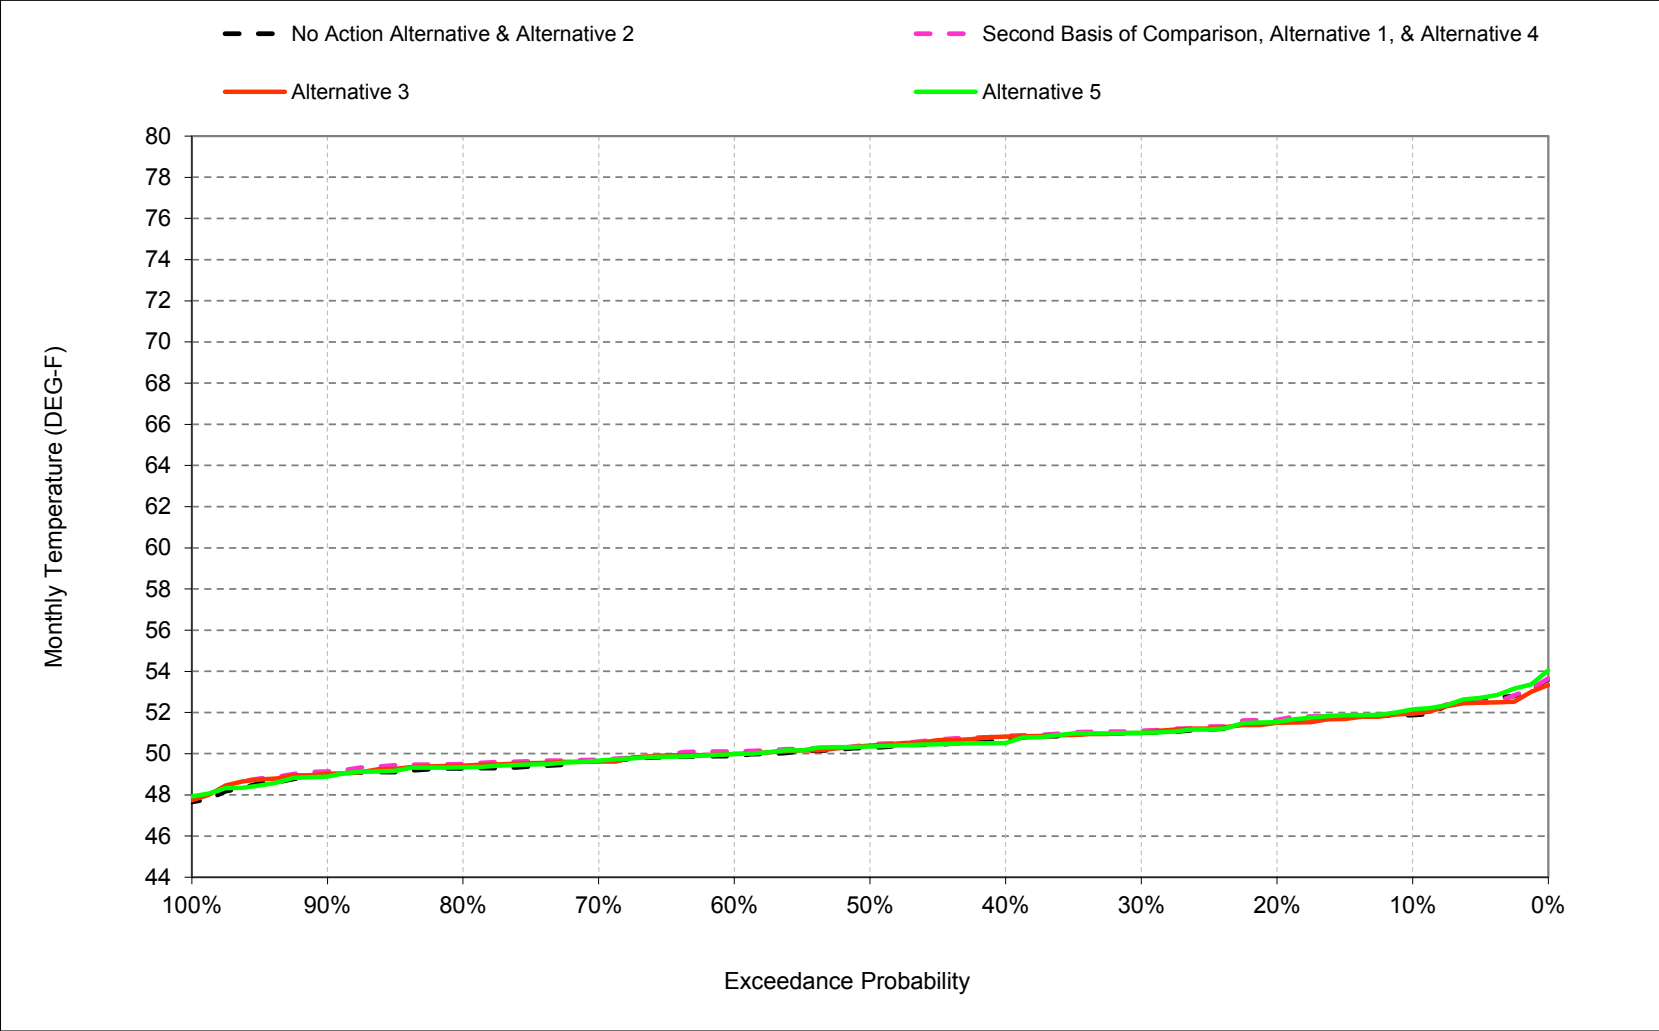


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-19-4. Stanislaus River at Mouth, January

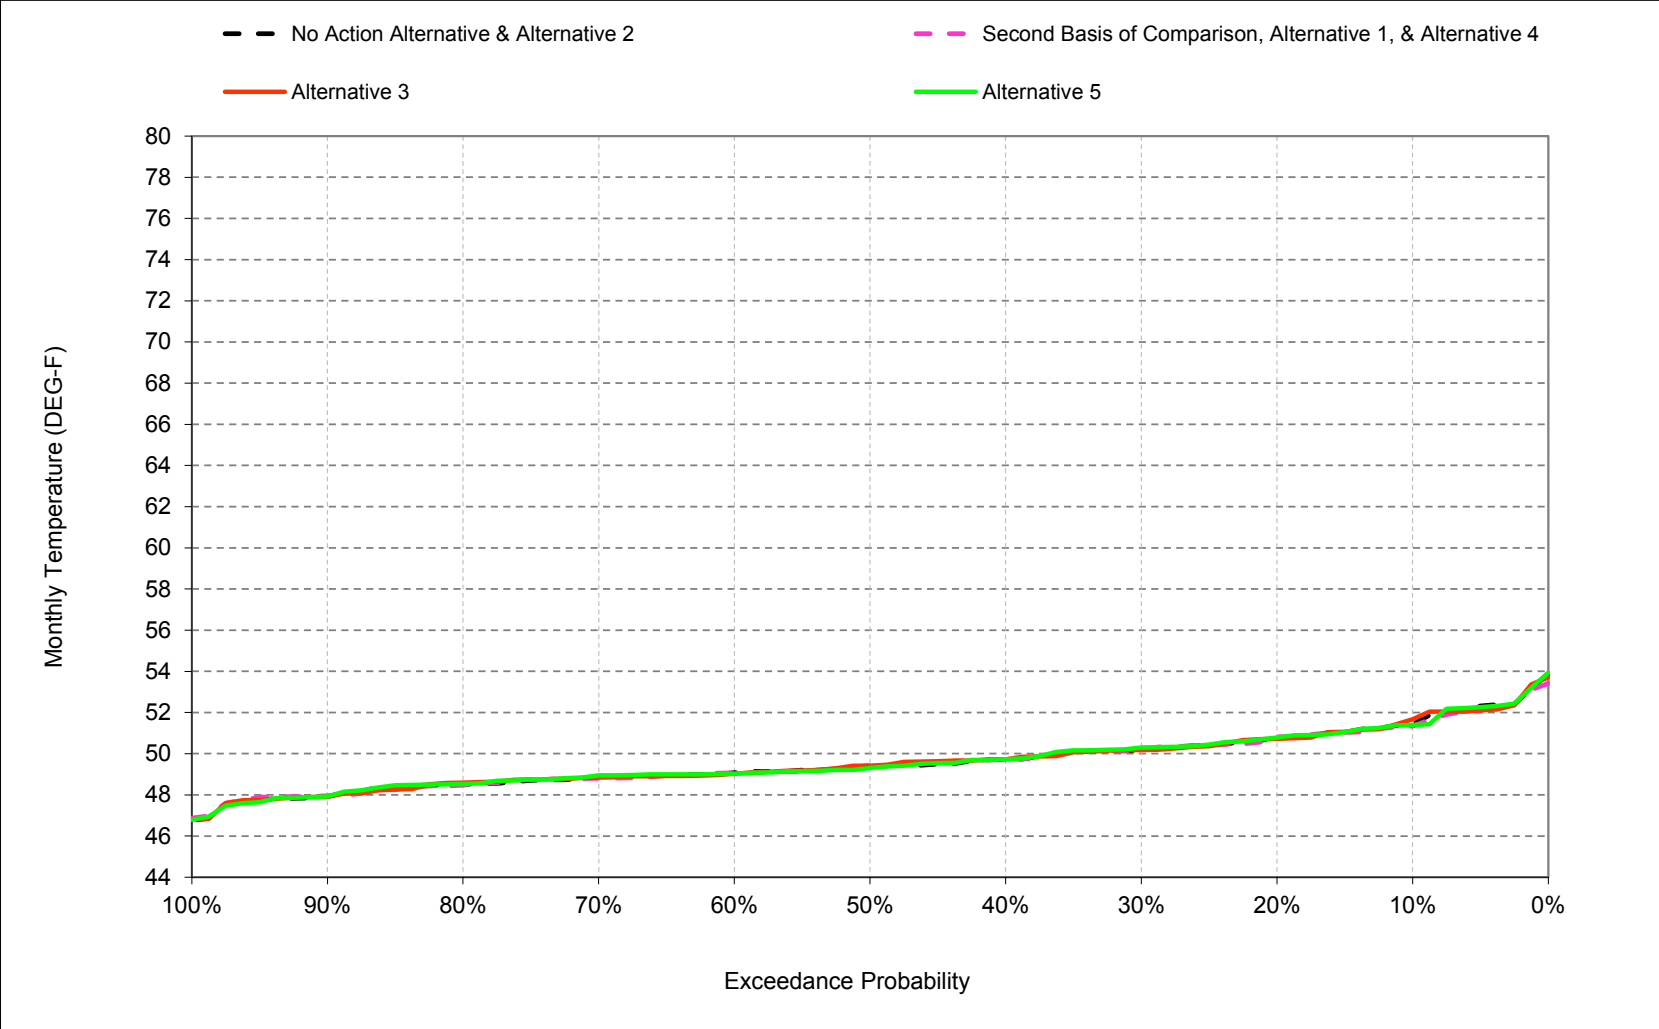


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-19-5. Stanislaus River at Mouth, February

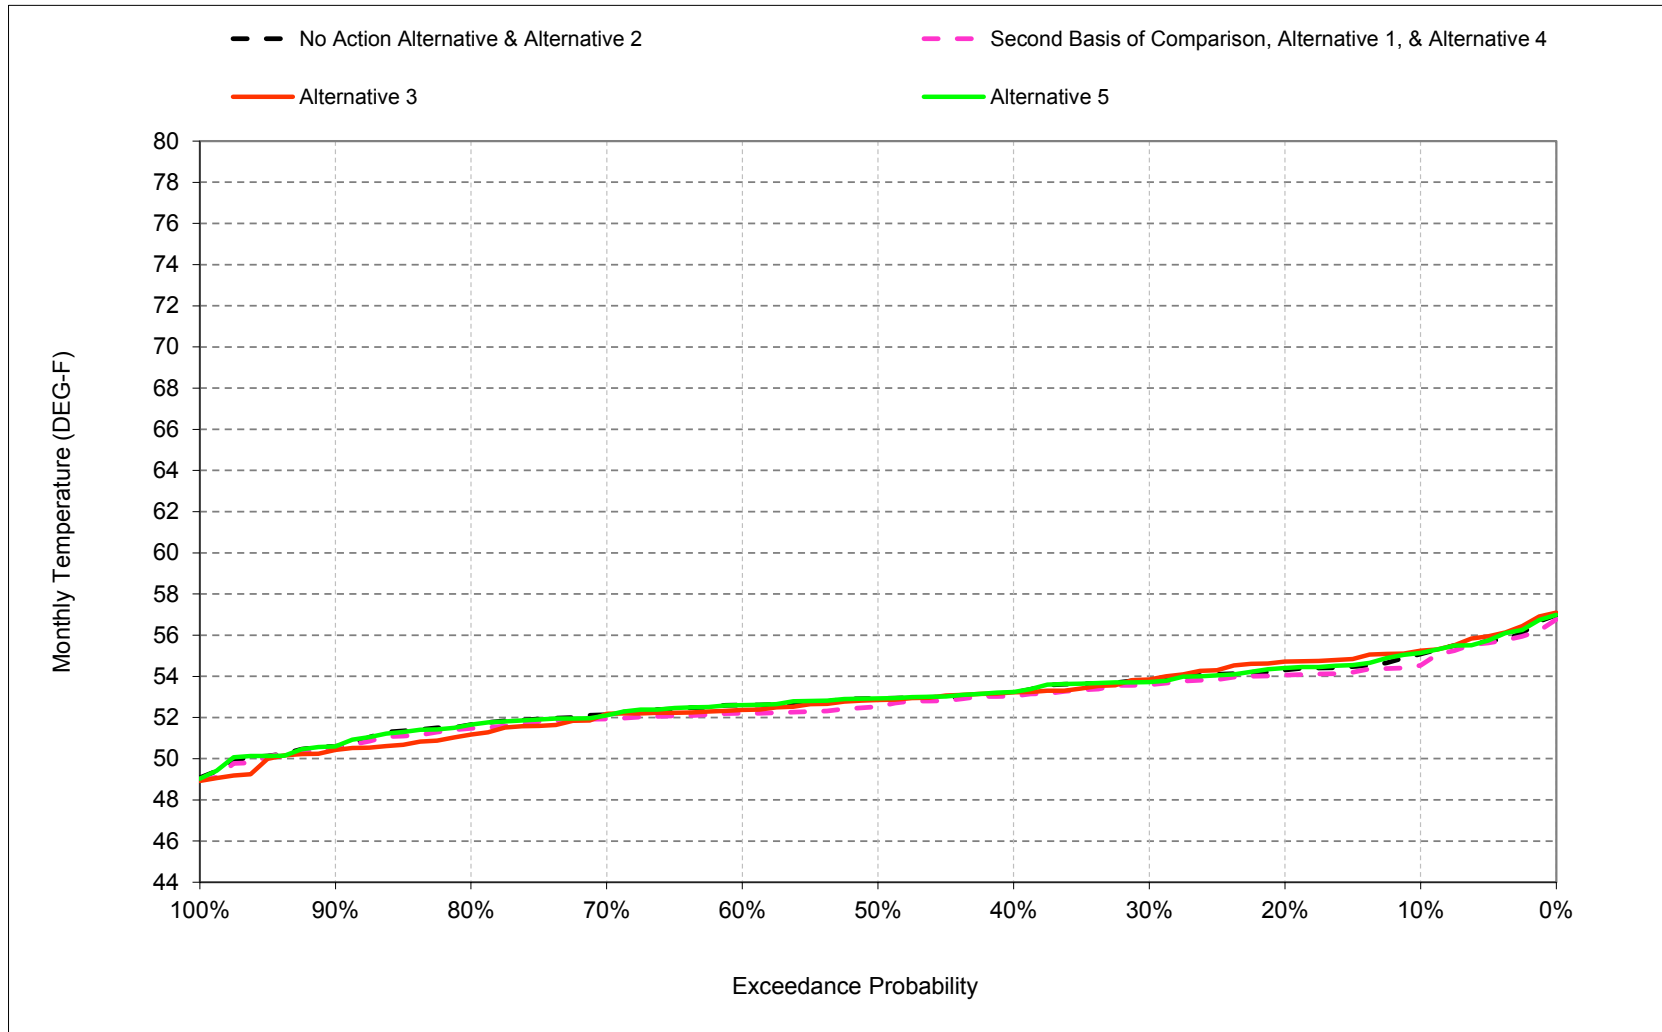


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-19-6. Stanislaus River at Mouth, March

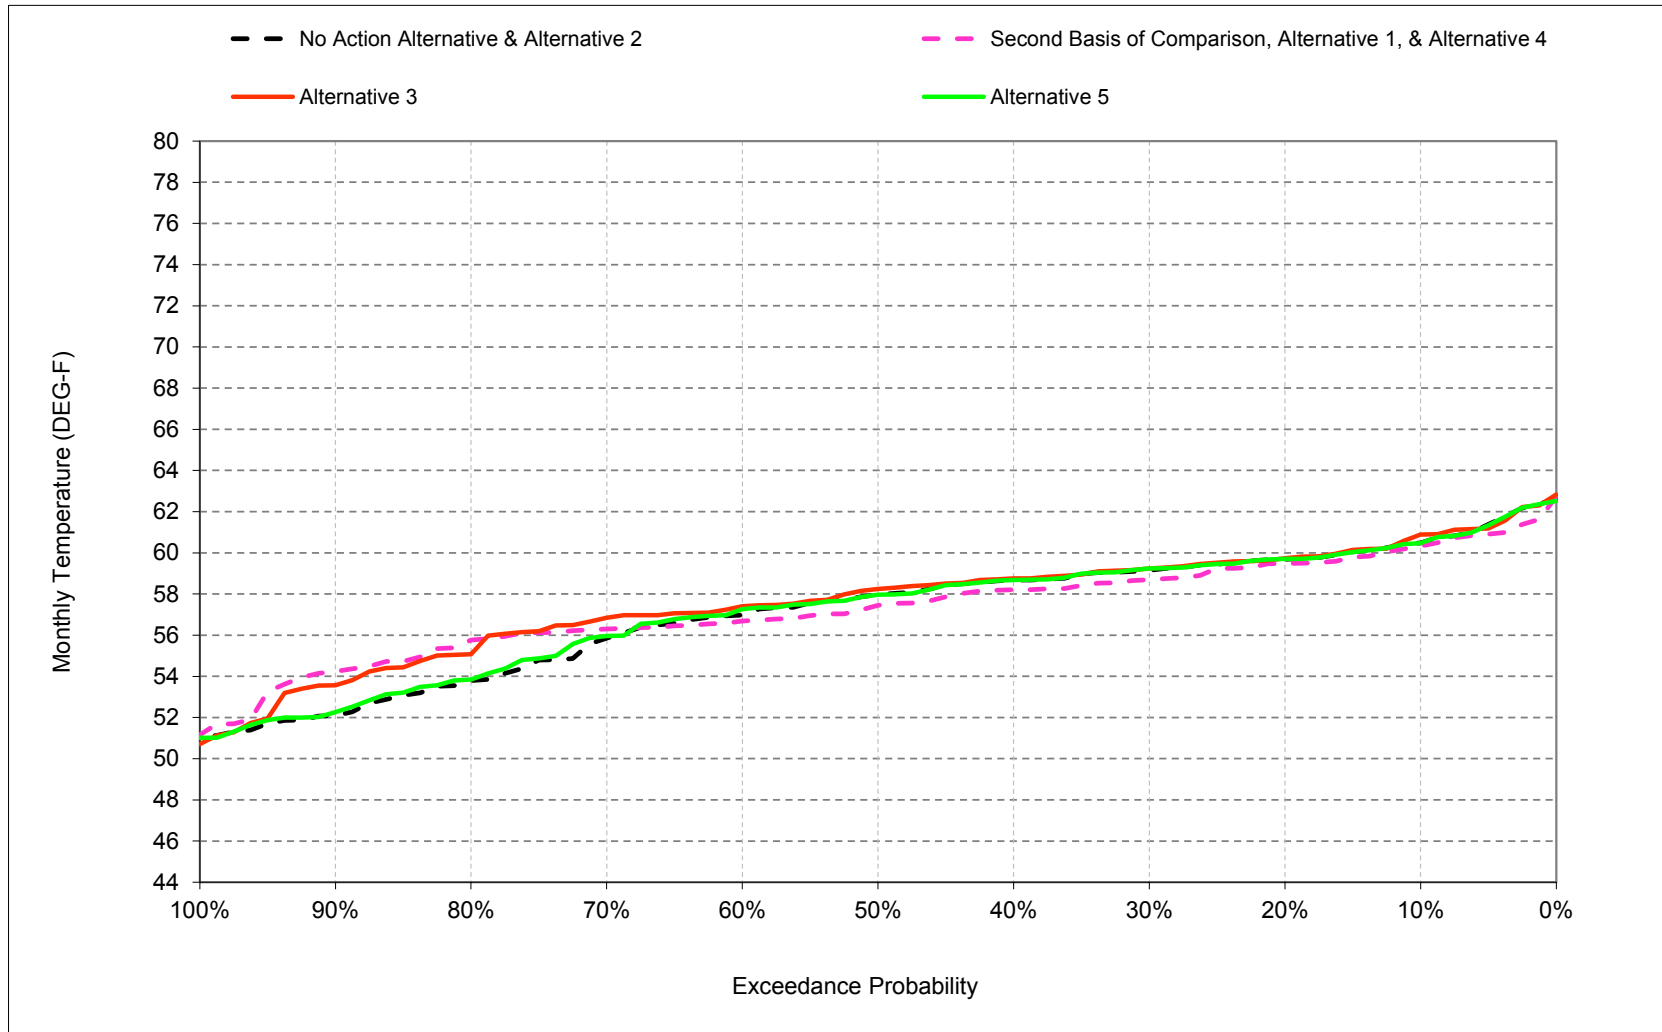


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-19-7. Stanislaus River at Mouth, April

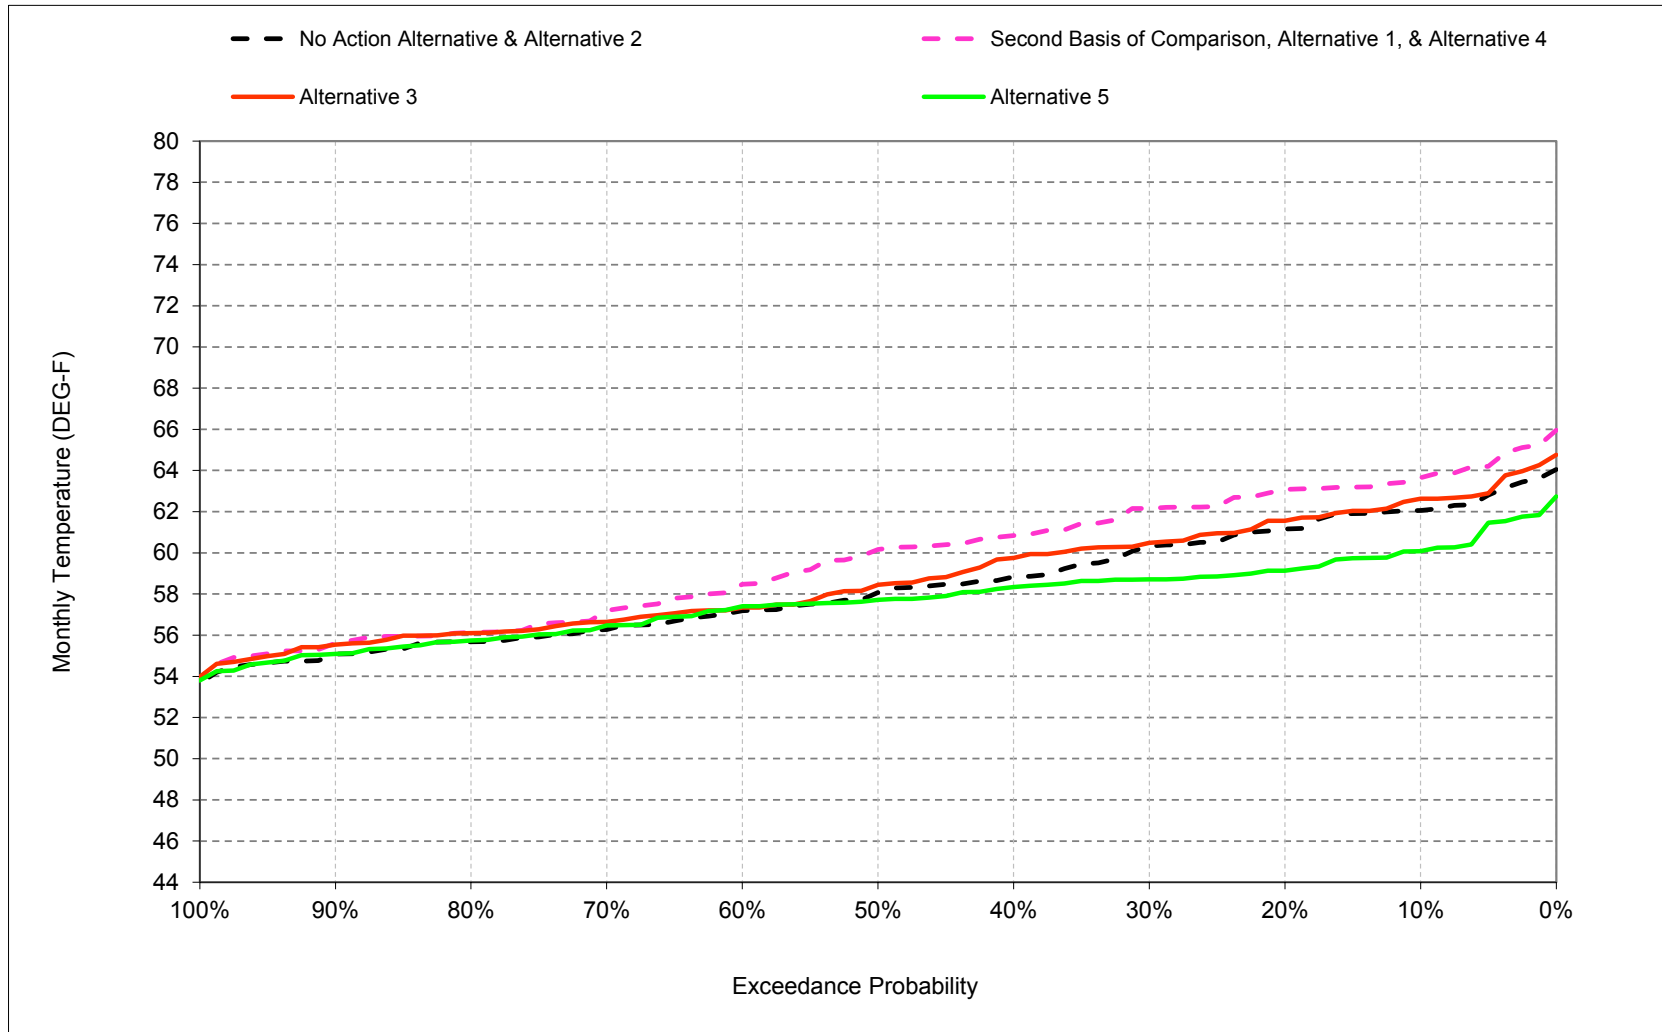


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-19-8. Stanislaus River at Mouth, May

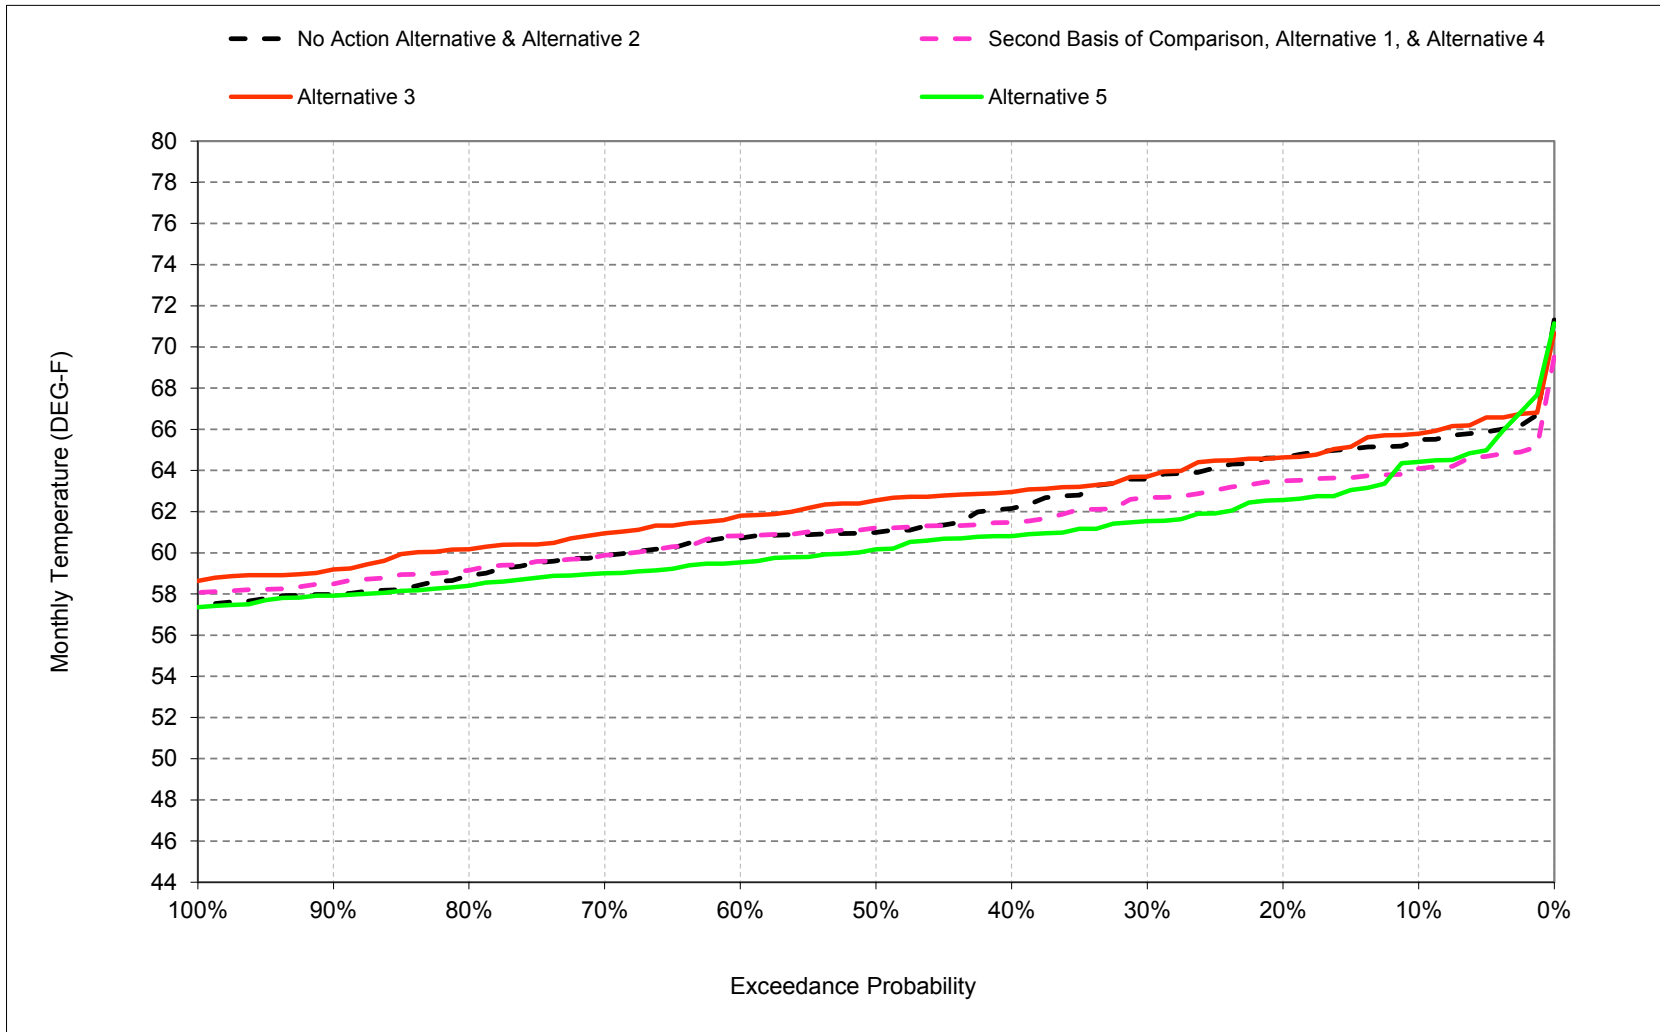


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-19-9. Stanislaus River at Mouth, June

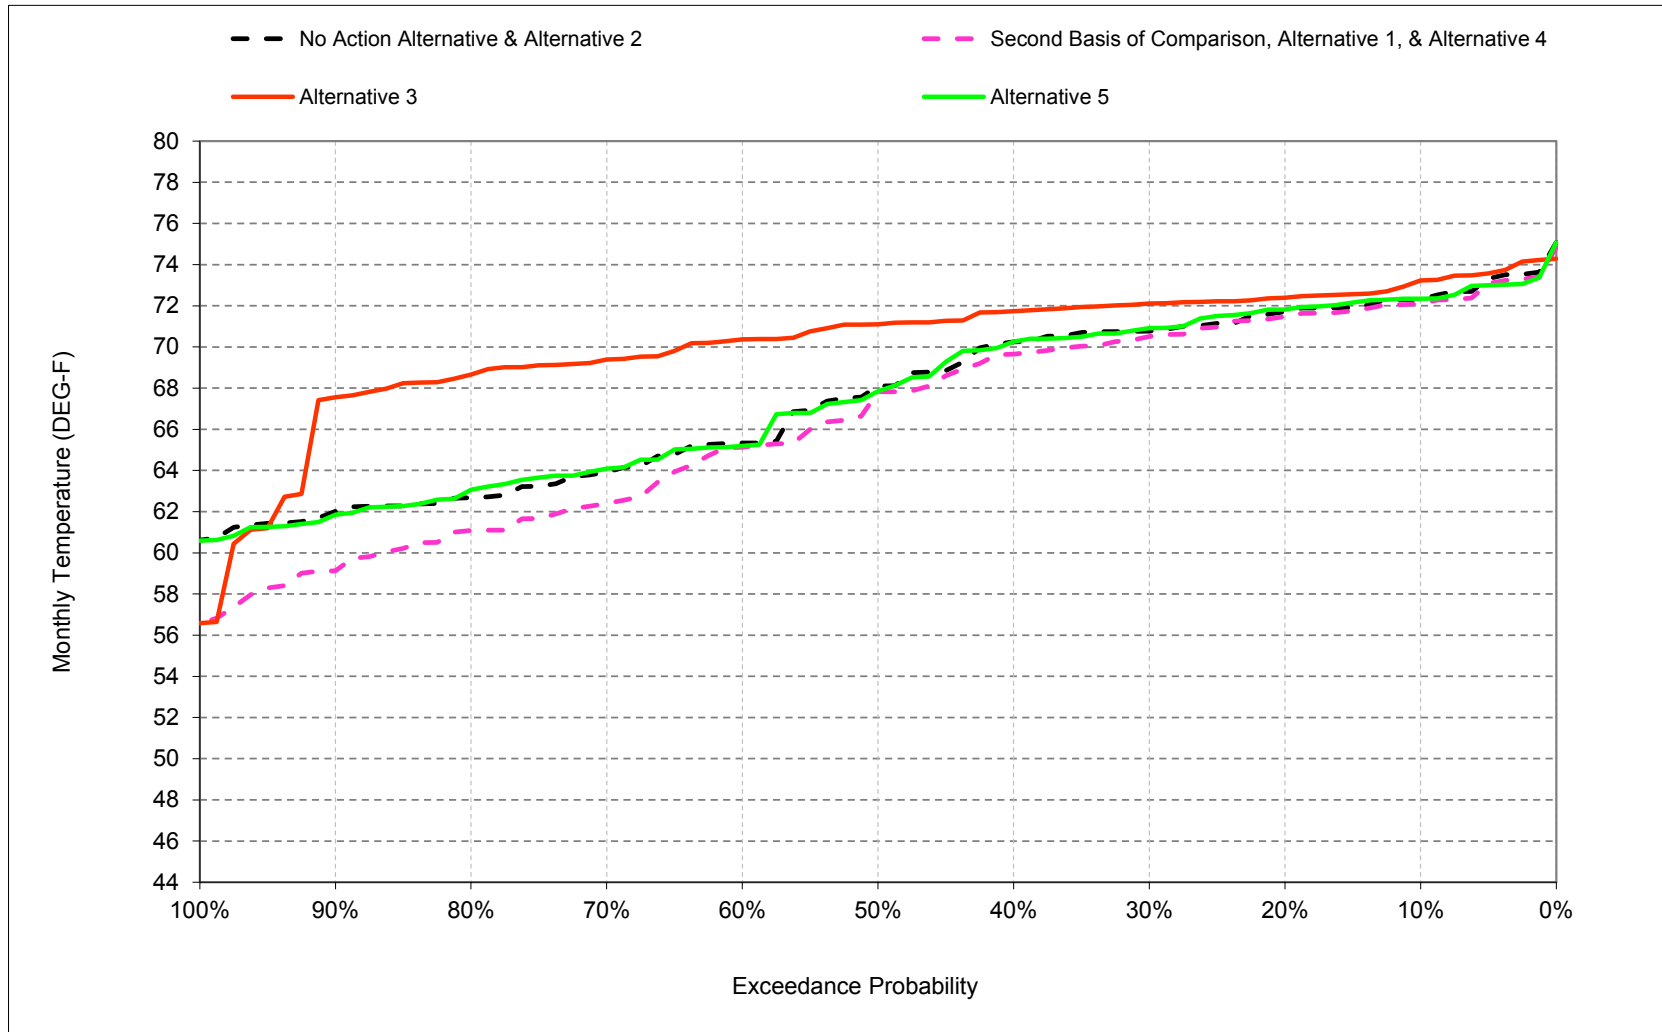


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-19-10. Stanislaus River at Mouth, July

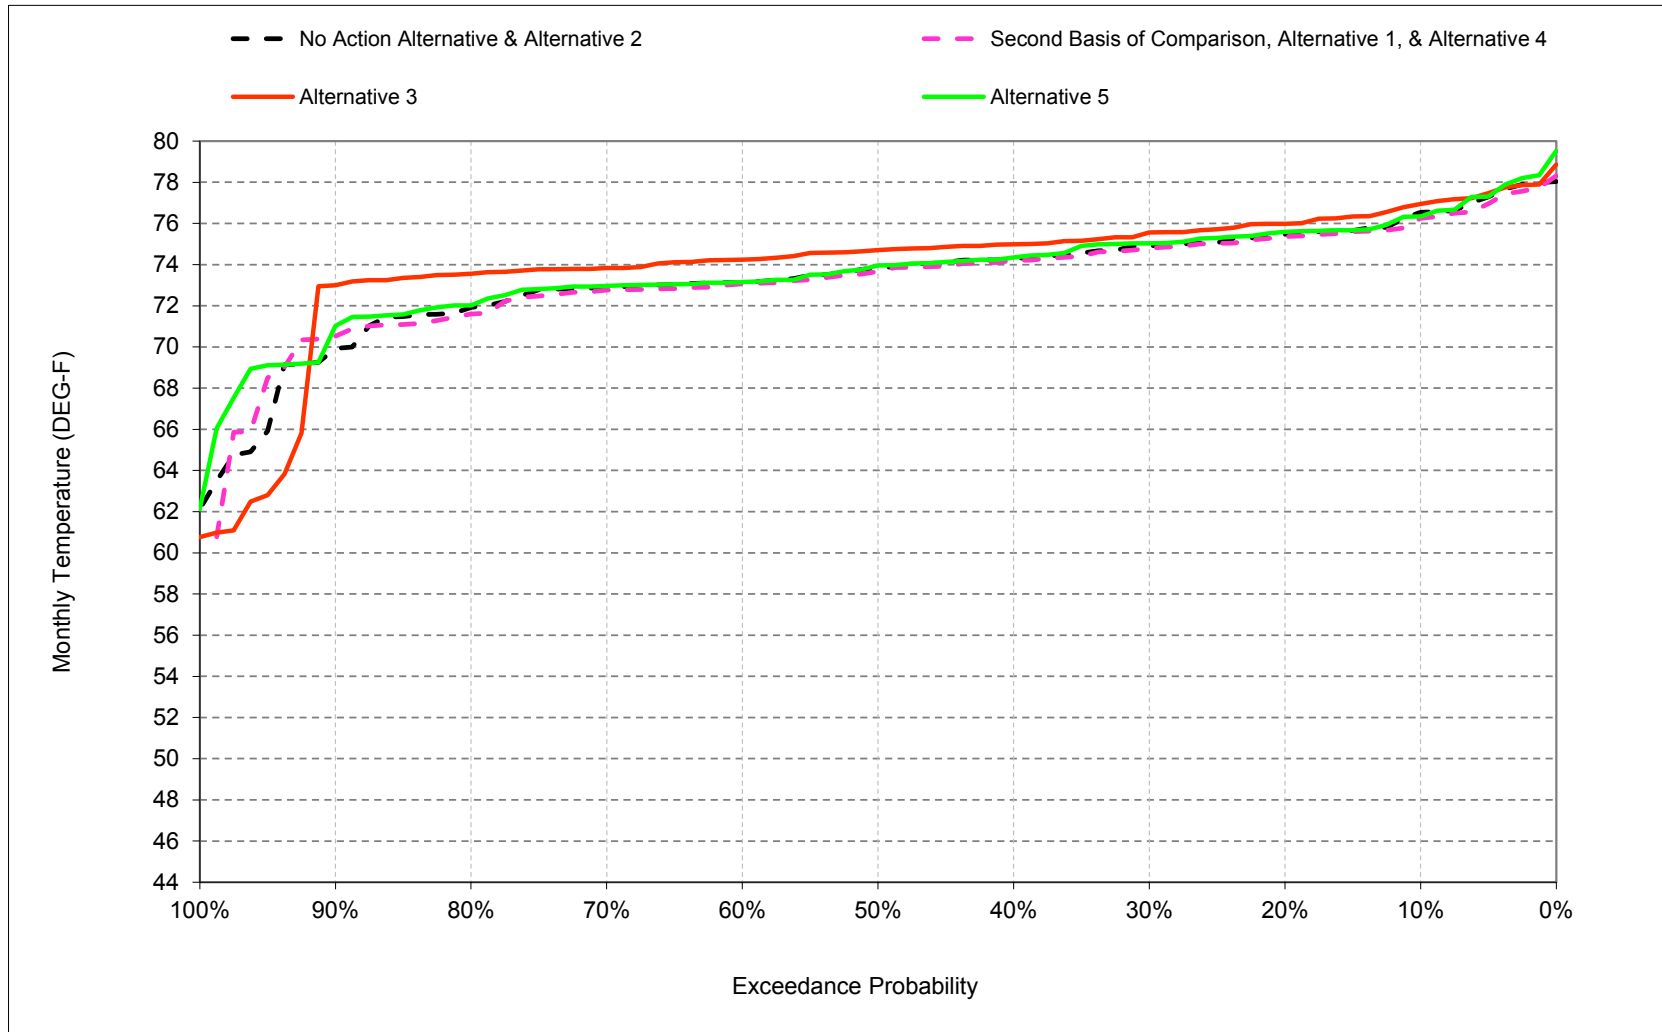


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-19-11. Stanislaus River at Mouth, August

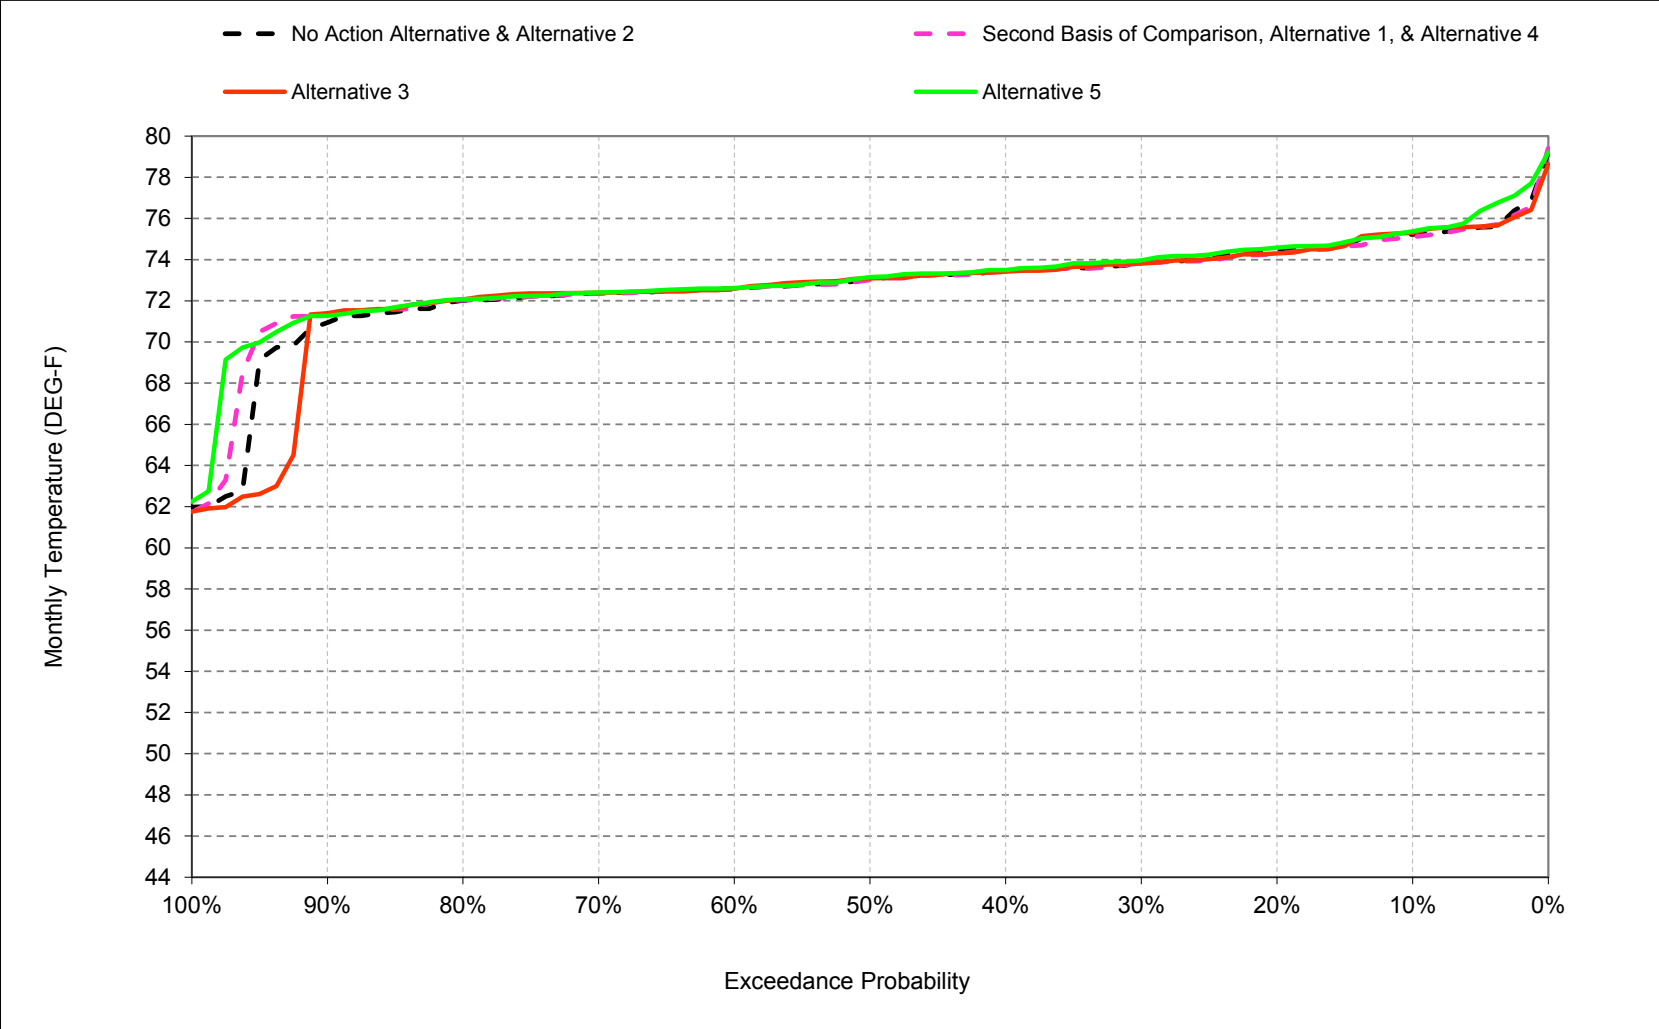

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-19-12. Stanislaus River at Mouth, September

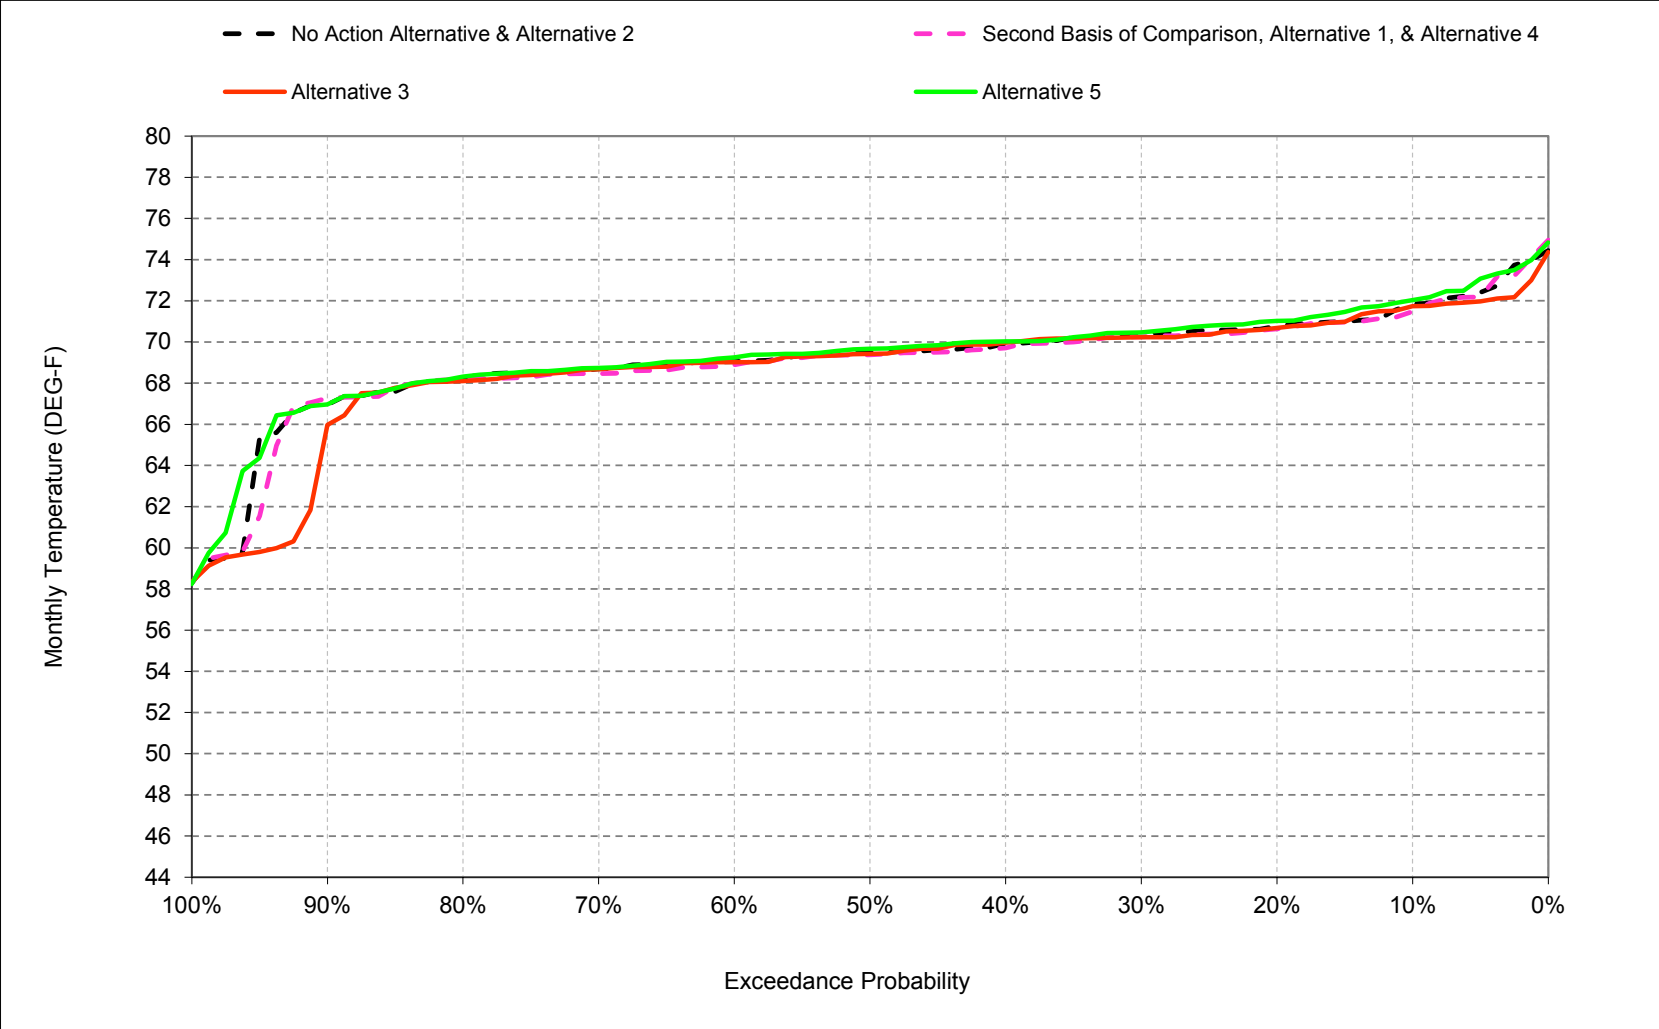

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-19-1. Stanislaus River at Mouth, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	64	59	52	51	55	60	62	65	72	77	75	72
20%	63	57	52	51	54	60	61	65	72	75	74	71
30%	62	57	51	50	54	59	60	64	71	75	74	70
40%	61	56	51	50	53	59	59	62	70	74	73	70
50%	60	56	50	49	53	58	58	61	68	74	73	69
60%	60	55	50	49	53	57	57	61	65	73	73	69
70%	59	55	50	49	52	56	56	60	64	73	72	69
80%	59	55	49	48	52	54	56	59	63	72	72	68
90%	58	54	49	48	51	52	55	58	62	69	71	67
Long Term												
Full Simulation Period ^b	61	56	50	50	53	57	58	62	67	73	73	69
Water Year Types ^c												
Wet (32%)	57	53	49	49	52	54	55	59	63	70	70	67
Above Normal (16%)	61	57	51	50	53	58	58	62	67	73	73	69
Below Normal (13%)	60	55	50	49	53	58	59	61	69	74	73	70
Dry (24%)	61	56	50	49	53	59	60	63	70	75	73	70
Critical (15%)	64	58	51	50	54	60	62	66	71	76	75	72

Alternative 1												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	67	58	52	51	55	60	64	64	72	76	75	71
20%	65	58	52	51	54	59	63	63	71	75	74	71
30%	64	57	51	50	54	59	62	63	70	75	74	70
40%	64	56	51	50	53	58	61	61	70	74	73	70
50%	63	56	50	49	52	57	60	61	67	74	73	69
60%	62	55	50	49	52	57	58	61	65	73	73	69
70%	62	55	50	49	52	56	57	60	62	73	72	68
80%	61	55	49	48	51	55	56	59	61	71	72	68
90%	61	54	49	48	50	54	55	58	59	70	71	67
Long Term												
Full Simulation Period ^b	63	56	51	50	53	57	60	61	66	73	73	69
Water Year Types ^c												
Wet (32%)	59	53	49	49	52	55	56	59	61	70	71	66
Above Normal (16%)	64	57	51	50	53	58	59	61	66	73	73	69
Below Normal (13%)	62	55	50	49	52	58	60	61	68	74	73	69
Dry (24%)	63	56	50	49	53	58	62	63	70	75	73	70
Critical (15%)	66	58	51	50	54	60	64	64	71	76	75	72

Alternative 1 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	2.2	-0.2	0.1	-0.1	-0.5	-0.2	1.6	-1.4	-0.2	-0.3	-0.1	-0.4
0.2	2.3	0.3	0.1	0.0	-0.2	-0.2	1.9	-1.1	-0.2	-0.1	-0.1	-0.1
0.3	2.6	0.1	0.1	0.0	-0.2	-0.4	1.9	-0.9	-0.3	-0.1	0.0	-0.2
0.4	3.2	-0.2	0.1	0.0	-0.2	-0.5	2.0	-0.7	-0.6	-0.1	0.0	-0.2
0.5	2.8	0.2	0.2	-0.1	-0.4	-0.6	2.1	0.2	-0.6	-0.2	0.0	-0.1
0.6	2.6	0.1	0.2	0.0	-0.4	-0.3	1.1	0.1	-0.2	-0.1	0.0	-0.2
0.7	2.7	0.1	0.0	0.0	-0.2	0.6	0.6	0.0	-1.5	-0.2	0.0	-0.2
0.8	2.6	0.0	0.2	0.0	-0.1	1.9	0.4	0.4	-1.6	-0.2	0.1	0.0
0.9	2.5	0.0	0.1	0.1	-0.2	2.1	0.5	0.5	-2.6	1.1	0.6	0.2
Long Term												
Full Simulation Period ^b	2.4	0.1	0.1	0.0	-0.2	0.2	1.3	-0.4	-1.0	-0.1	0.1	-0.1
Water Year Types ^c												
Wet (32%)	2.2	-0.1	0.0	-0.1	-0.2	1.1	0.4	0.4	-2.4	0.0	0.5	-0.1
Above Normal (16%)	2.6	0.0	0.1	-0.1	-0.3	0.0	1.3	-0.5	-0.6	-0.1	0.0	-0.1
Below Normal (13%)	2.2	-0.2	0.1	-0.1	-0.4	-0.4	1.9	-0.2	-0.7	-0.2	0.0	-0.2
Dry (24%)	2.7	0.2	0.2	0.0	-0.3	-0.4	2.0	-0.8	-0.2	0.0	0.0	-0.1
Critical (15%)	1.8	0.4	0.3	0.1	0.0	0.0	1.5	-1.2	-0.3	-0.2	-0.1	-0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-19-2. Stanislaus River at Mouth, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	64	59	52	51	55	60	62	65	72	77	75	72
20%	63	57	52	51	54	60	61	65	72	75	74	71
30%	62	57	51	50	54	59	60	64	71	75	74	70
40%	61	56	51	50	53	59	59	62	70	74	73	70
50%	60	56	50	49	53	58	58	61	68	74	73	69
60%	60	55	50	49	53	57	57	61	65	73	73	69
70%	59	55	50	49	52	56	56	60	64	73	72	69
80%	59	55	49	48	52	54	56	59	63	72	72	68
90%	58	54	49	48	51	52	55	58	62	69	71	67
Long Term												
Full Simulation Period ^b	61	56	50	50	53	57	58	62	67	73	73	69
Water Year Types ^c												
Wet (32%)	57	53	49	49	52	54	55	59	63	70	70	67
Above Normal (16%)	61	57	51	50	53	58	58	62	67	73	73	69
Below Normal (13%)	60	55	50	49	53	58	59	61	69	74	73	70
Dry (24%)	61	56	50	49	53	59	60	63	70	75	73	70
Critical (15%)	64	58	51	50	54	60	62	66	71	76	75	72

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	66	58	52	52	55	61	63	66	73	77	75	72
20%	65	58	52	51	55	60	62	65	72	76	74	71
30%	64	57	51	50	54	59	60	64	72	75	74	70
40%	63	56	51	50	53	59	60	63	72	75	73	70
50%	63	56	50	49	53	58	58	62	71	75	73	69
60%	62	55	50	49	52	57	57	62	70	74	73	69
70%	62	55	50	49	52	57	57	61	69	74	72	69
80%	61	55	49	49	51	55	56	60	68	74	72	68
90%	61	54	49	48	50	54	55	59	67	73	71	62
Long Term												
Full Simulation Period ^b	63	56	50	50	53	58	59	62	70	74	72	69
Water Year Types ^c												
Wet (32%)	59	53	49	49	51	55	56	60	67	71	70	66
Above Normal (16%)	64	57	51	50	53	58	58	62	71	75	73	69
Below Normal (13%)	62	55	50	49	52	58	59	62	71	75	73	69
Dry (24%)	63	56	50	49	54	59	60	64	72	75	73	70
Critical (15%)	65	58	51	50	55	60	62	66	72	76	75	71

Alternative 3 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	1.4	-0.3	0.1	0.2	0.2	0.4	0.6	0.3	0.9	0.4	0.1	-0.1
0.2	2.2	0.2	-0.1	0.0	0.4	0.0	0.4	0.0	0.7	0.5	-0.1	-0.1
0.3	2.3	-0.1	0.0	0.0	0.0	0.1	0.2	0.1	1.3	0.6	0.0	-0.2
0.4	2.6	-0.2	0.1	0.0	0.0	0.1	1.0	0.8	1.5	0.7	-0.1	0.1
0.5	2.7	-0.1	0.1	0.0	-0.1	0.3	0.4	1.5	3.3	0.9	0.1	0.0
0.6	2.8	0.1	0.1	0.0	-0.3	0.3	0.2	1.0	5.0	1.1	0.0	0.0
0.7	2.7	0.0	0.0	0.0	-0.2	1.1	0.4	1.1	5.4	0.9	0.0	0.0
0.8	2.6	0.1	0.1	0.1	-0.5	1.4	0.4	1.5	5.8	1.8	0.1	-0.1
0.9	2.4	0.0	0.0	0.0	-0.3	1.5	0.6	1.1	5.7	3.6	0.7	-4.7
Long Term												
Full Simulation Period ^b	2.2	0.0	0.0	0.0	-0.1	0.5	0.4	0.8	2.6	0.6	-0.2	-0.4
Water Year Types ^c												
Wet (32%)	2.0	0.0	0.0	0.0	-0.3	1.3	0.3	1.2	3.8	0.4	-0.6	-0.8
Above Normal (16%)	2.6	0.0	0.0	0.0	-0.3	-0.2	0.4	0.8	4.2	1.7	0.2	0.1
Below Normal (13%)	2.1	-0.1	0.0	0.0	-0.4	0.3	0.7	1.0	2.1	0.6	0.0	0.0
Dry (24%)	2.6	0.1	0.1	0.0	0.3	0.1	0.4	0.6	1.3	0.4	-0.1	-0.2
Critical (15%)	1.2	0.0	0.1	0.0	0.5	0.3	0.3	0.2	0.9	0.3	-0.2	-0.6

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-19-3. Stanislaus River at Mouth, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	64	59	52	51	55	60	62	65	72	77	75	72
20%	63	57	52	51	54	60	61	65	72	75	74	71
30%	62	57	51	50	54	59	60	64	71	75	74	70
40%	61	56	51	50	53	59	59	62	70	74	73	70
50%	60	56	50	49	53	58	58	61	68	74	73	69
60%	60	55	50	49	53	57	57	61	65	73	73	69
70%	59	55	50	49	52	56	56	60	64	73	72	69
80%	59	55	49	48	52	54	56	59	63	72	72	68
90%	58	54	49	48	51	52	55	58	62	69	71	67
Long Term												
Full Simulation Period ^b	61	56	50	50	53	57	58	62	67	73	73	69
Water Year Types ^c												
Wet (32%)	57	53	49	49	52	54	55	59	63	70	70	67
Above Normal (16%)	61	57	51	50	53	58	58	62	67	73	73	69
Below Normal (13%)	60	55	50	49	53	58	59	61	69	74	73	70
Dry (24%)	61	56	50	49	53	59	60	63	70	75	73	70
Critical (15%)	64	58	51	50	54	60	62	66	71	76	75	72

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	65	59	52	51	55	60	60	64	72	76	75	72
20%	63	58	52	51	54	60	59	63	72	76	75	71
30%	62	57	51	50	54	59	59	62	71	75	74	70
40%	61	57	51	50	53	59	58	61	70	74	73	70
50%	60	56	50	49	53	58	58	60	68	74	73	70
60%	60	55	50	49	53	57	57	60	65	73	73	69
70%	59	55	50	49	52	56	56	59	64	73	72	69
80%	59	55	49	49	52	54	56	58	63	72	72	68
90%	58	54	49	48	51	52	55	58	62	69	71	67
Long Term												
Full Simulation Period ^b	61	56	50	50	53	57	58	61	67	73	73	69
Water Year Types ^c												
Wet (32%)	57	53	49	49	52	54	56	58	63	71	71	67
Above Normal (16%)	61	57	51	50	53	58	58	60	67	73	73	69
Below Normal (13%)	61	55	50	49	53	58	58	60	69	74	73	70
Dry (24%)	61	56	50	49	53	59	59	62	70	75	74	70
Critical (15%)	64	58	51	50	54	60	60	64	72	76	76	72

Alternative 5 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	1.1	0.1	0.3	0.0	0.1	0.0	-2.0	-1.1	0.0	-0.2	0.1	0.2
0.2	0.4	0.3	-0.1	0.0	0.1	0.0	-2.0	-2.0	0.1	0.1	0.2	0.3
0.3	0.3	0.2	0.0	0.1	-0.1	0.1	-1.5	-2.1	0.1	0.1	0.1	0.0
0.4	0.5	0.2	-0.2	0.0	0.1	0.0	-0.5	-1.3	-0.1	0.0	0.0	0.2
0.5	0.3	0.3	0.1	-0.1	0.0	0.0	-0.2	-0.9	-0.2	0.1	0.1	0.2
0.6	0.1	0.1	0.1	0.0	0.0	0.1	0.2	-1.2	-0.2	0.0	0.0	0.2
0.7	0.2	0.0	0.0	0.0	-0.1	0.2	0.1	-0.8	0.2	0.1	0.0	0.1
0.8	0.1	0.1	0.1	0.0	0.0	0.2	0.0	-0.4	0.1	0.3	0.1	0.1
0.9	0.0	0.0	-0.2	0.0	0.0	0.0	0.2	-0.1	-0.2	0.1	0.6	0.0
Long Term												
Full Simulation Period ^b	0.3	0.2	0.1	0.0	0.0	0.1	-0.6	-1.0	0.0	0.3	0.4	0.2
Water Year Types ^c												
Wet (32%)	0.4	0.2	0.1	0.0	0.0	0.2	0.1	-0.5	0.1	0.7	0.8	0.3
Above Normal (16%)	0.3	0.1	0.1	0.0	0.0	0.0	-0.3	-1.2	-0.2	0.0	0.0	0.0
Below Normal (13%)	0.5	0.0	0.0	0.0	0.0	0.0	-0.4	-0.8	0.2	0.1	0.1	0.2
Dry (24%)	0.4	0.2	0.1	0.0	0.1	0.0	-1.1	-1.3	-0.1	0.1	0.2	0.3
Critical (15%)	0.2	0.3	0.0	0.0	0.0	0.0	-2.1	-1.6	0.1	0.3	0.3	0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-19-4. Stanislaus River at Mouth, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	67	58	52	51	55	60	64	64	72	76	75	71
20%	65	58	52	51	54	59	63	63	71	75	74	71
30%	64	57	51	50	54	59	62	63	70	75	74	70
40%	64	56	51	50	53	58	61	61	70	74	73	70
50%	63	56	50	49	52	57	60	61	67	74	73	69
60%	62	55	50	49	52	57	58	61	65	73	73	69
70%	62	55	50	49	52	56	57	60	62	73	72	68
80%	61	55	49	48	51	55	56	59	61	71	72	68
90%	61	54	49	48	50	54	55	58	59	70	71	67
Long Term												
Full Simulation Period ^b	63	56	51	50	53	57	60	61	66	73	73	69
Water Year Types ^c												
Wet (32%)	59	53	49	49	52	55	56	59	61	70	71	66
Above Normal (16%)	64	57	51	50	53	58	59	61	66	73	73	69
Below Normal (13%)	62	55	50	49	52	58	60	61	68	74	73	69
Dry (24%)	63	56	50	49	53	58	62	63	70	75	73	70
Critical (15%)	66	58	51	50	54	60	64	64	71	76	75	72

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	64	59	52	51	55	60	62	65	72	77	75	72
20%	63	57	52	51	54	60	61	65	72	75	74	71
30%	62	57	51	50	54	59	60	64	71	75	74	70
40%	61	56	51	50	53	59	59	62	70	74	73	70
50%	60	56	50	49	53	58	58	61	68	74	73	69
60%	60	55	50	49	53	57	57	61	65	73	73	69
70%	59	55	50	49	52	56	56	60	64	73	72	69
80%	59	55	49	48	52	54	56	59	63	72	72	68
90%	58	54	49	48	51	52	55	58	62	69	71	67
Long Term												
Full Simulation Period ^b	61	56	50	50	53	57	58	62	67	73	73	69
Water Year Types ^c												
Wet (32%)	57	53	49	49	52	54	55	59	63	70	70	67
Above Normal (16%)	61	57	51	50	53	58	58	62	67	73	73	69
Below Normal (13%)	60	55	50	49	53	58	59	61	69	74	73	70
Dry (24%)	61	56	50	49	53	59	60	63	70	75	73	70
Critical (15%)	64	58	51	50	54	60	62	66	71	76	75	72

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-2.2	0.2	-0.1	0.1	0.5	0.2	-1.6	1.4	0.2	0.3	0.1	0.4
0.2	-2.3	-0.3	-0.1	0.0	0.2	0.2	-1.9	1.1	0.2	0.1	0.1	0.1
0.3	-2.6	-0.1	-0.1	0.0	0.2	0.4	-1.9	0.9	0.3	0.1	0.0	0.2
0.4	-3.2	0.2	-0.1	0.0	0.2	0.5	-2.0	0.7	0.6	0.1	0.0	0.2
0.5	-2.8	-0.2	-0.2	0.1	0.4	0.6	-2.1	-0.2	0.6	0.2	0.0	0.1
0.6	-2.6	-0.1	-0.2	0.0	0.4	0.3	-1.1	-0.1	0.2	0.1	0.0	0.2
0.7	-2.7	-0.1	0.0	0.0	0.2	-0.6	-0.6	0.0	1.5	0.2	0.0	0.2
0.8	-2.6	0.0	-0.2	0.0	0.1	-1.9	-0.4	-0.4	1.6	0.2	-0.1	0.0
0.9	-2.5	0.0	-0.1	-0.1	0.2	-2.1	-0.5	-0.5	2.6	-1.1	-0.6	-0.2
Long Term												
Full Simulation Period ^b	-2.4	-0.1	-0.1	0.0	0.2	-0.2	-1.3	0.4	1.0	0.1	-0.1	0.1
Water Year Types ^c												
Wet (32%)	-2.2	0.1	0.0	0.1	0.2	-1.1	-0.4	-0.4	2.4	0.0	-0.5	0.1
Above Normal (16%)	-2.6	0.0	-0.1	0.1	0.3	0.0	-1.3	0.5	0.6	0.1	0.0	0.1
Below Normal (13%)	-2.2	0.2	-0.1	0.1	0.4	0.4	-1.9	0.2	0.7	0.2	0.0	0.2
Dry (24%)	-2.7	-0.2	-0.2	0.0	0.3	0.4	-2.0	0.8	0.2	0.0	0.0	0.1
Critical (15%)	-1.8	-0.4	-0.3	-0.1	0.0	0.0	-1.5	1.2	0.3	0.2	0.1	0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-19-5. Stanislaus River at Mouth, Monthly Temperature

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	67	58	52	51	55	60	64	64	72	76	75	71
20%	65	58	52	51	54	59	63	63	71	75	74	71
30%	64	57	51	50	54	59	62	63	70	75	74	70
40%	64	56	51	50	53	58	61	61	70	74	73	70
50%	63	56	50	49	52	57	60	61	67	74	73	69
60%	62	55	50	49	52	57	58	61	65	73	73	69
70%	62	55	50	49	52	56	57	60	62	73	72	68
80%	61	55	49	48	51	55	56	59	61	71	72	68
90%	61	54	49	48	50	54	55	58	59	70	71	67
Long Term												
Full Simulation Period ^b	63	56	51	50	53	57	60	61	66	73	73	69
Water Year Types ^c												
Wet (32%)	59	53	49	49	52	55	56	59	61	70	71	66
Above Normal (16%)	64	57	51	50	53	58	59	61	66	73	73	69
Below Normal (13%)	62	55	50	49	52	58	60	61	68	74	73	69
Dry (24%)	63	56	50	49	53	58	62	63	70	75	73	70
Critical (15%)	66	58	51	50	54	60	64	64	71	76	75	72

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 3												
Probability of Exceedance ^a												
10%	66	58	52	52	55	61	63	66	73	77	75	72
20%	65	58	52	51	55	60	62	65	72	76	74	71
30%	64	57	51	50	54	59	60	64	72	75	74	70
40%	63	56	51	50	53	59	60	63	72	75	73	70
50%	63	56	50	49	53	58	58	62	71	75	73	69
60%	62	55	50	49	52	57	57	62	70	74	73	69
70%	62	55	50	49	52	57	57	61	69	74	72	69
80%	61	55	49	49	51	55	56	60	68	74	72	68
90%	61	54	49	48	50	54	55	59	67	73	71	62
Long Term												
Full Simulation Period ^b	63	56	50	50	53	58	59	62	70	74	72	69
Water Year Types ^c												
Wet (32%)	59	53	49	49	51	55	56	60	67	71	70	66
Above Normal (16%)	64	57	51	50	53	58	58	62	71	75	73	69
Below Normal (13%)	62	55	50	49	52	58	59	62	71	75	73	69
Dry (24%)	63	56	50	49	54	59	60	64	72	75	73	70
Critical (15%)	65	58	51	50	55	60	62	66	72	76	75	71

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 3 minus Second Basis of Comparison												
Probability of Exceedance ^a												
0.1	-0.8	-0.1	0.0	0.3	0.7	0.5	-1.0	1.7	1.1	0.7	0.2	0.3
0.2	-0.1	-0.1	-0.1	0.0	0.6	0.2	-1.5	1.1	0.9	0.6	0.0	0.1
0.3	-0.3	-0.2	-0.1	0.0	0.3	0.5	-1.7	1.0	1.6	0.7	0.0	0.0
0.4	-0.6	0.0	0.0	0.0	0.2	0.5	-1.1	1.5	2.1	0.8	0.0	0.3
0.5	0.0	-0.2	-0.1	0.1	0.3	0.9	-1.7	1.3	3.9	1.1	0.1	0.0
0.6	0.1	0.0	-0.1	-0.1	0.1	0.7	-1.0	0.9	5.2	1.2	-0.1	0.2
0.7	0.0	-0.1	-0.1	0.0	0.0	0.4	-0.2	1.1	7.0	1.1	0.0	0.2
0.8	0.1	0.1	-0.1	0.1	-0.4	-0.4	0.0	1.1	7.5	2.0	0.0	-0.1
0.9	-0.2	0.1	-0.1	0.0	-0.1	-0.6	0.1	0.6	8.3	2.6	0.1	-4.8
Long Term												
Full Simulation Period ^b	-0.2	-0.1	-0.1	0.0	0.1	0.3	-0.9	1.2	3.6	0.7	-0.3	-0.2
Water Year Types ^c												
Wet (32%)	-0.2	0.0	0.0	0.1	-0.1	0.2	-0.1	0.8	6.1	0.4	-1.1	-0.6
Above Normal (16%)	0.0	0.0	-0.1	0.1	0.0	-0.1	-0.9	1.2	4.9	1.8	0.2	0.2
Below Normal (13%)	-0.2	0.0	-0.2	0.0	0.0	0.6	-1.2	1.2	2.8	0.7	0.0	0.2
Dry (24%)	-0.2	0.0	0.0	0.0	0.5	0.5	-1.6	1.4	1.5	0.4	0.0	-0.1
Critical (15%)	-0.6	-0.4	-0.2	-0.1	0.5	0.3	-1.2	1.4	1.2	0.5	-0.1	-0.5

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-19-6. Stanislaus River at Mouth, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	67	58	52	51	55	60	64	64	72	76	75	71
20%	65	58	52	51	54	59	63	63	71	75	74	71
30%	64	57	51	50	54	59	62	63	70	75	74	70
40%	64	56	51	50	53	58	61	61	70	74	73	70
50%	63	56	50	49	52	57	60	61	67	74	73	69
60%	62	55	50	49	52	57	58	61	65	73	73	69
70%	62	55	50	49	52	56	57	60	62	73	72	68
80%	61	55	49	48	51	55	56	59	61	71	72	68
90%	61	54	49	48	50	54	55	58	59	70	71	67
Long Term												
Full Simulation Period ^b	63	56	51	50	53	57	60	61	66	73	73	69
Water Year Types ^c												
Wet (32%)	59	53	49	49	52	55	56	59	61	70	71	66
Above Normal (16%)	64	57	51	50	53	58	59	61	66	73	73	69
Below Normal (13%)	62	55	50	49	52	58	60	61	68	74	73	69
Dry (24%)	63	56	50	49	53	58	62	63	70	75	73	70
Critical (15%)	66	58	51	50	54	60	64	64	71	76	75	72

Alternative 5

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	65	59	52	51	55	60	60	64	72	76	75	72
20%	63	58	52	51	54	60	59	63	72	76	75	71
30%	62	57	51	50	54	59	59	62	71	75	74	70
40%	61	57	51	50	53	59	58	61	70	74	73	70
50%	60	56	50	49	53	58	58	60	68	74	73	70
60%	60	55	50	49	53	57	57	60	65	73	73	69
70%	59	55	50	49	52	56	56	59	64	73	72	69
80%	59	55	49	49	52	54	56	58	63	72	72	68
90%	58	54	49	48	51	52	55	58	62	69	71	67
Long Term												
Full Simulation Period ^b	61	56	50	50	53	57	58	61	67	73	73	69
Water Year Types ^c												
Wet (32%)	57	53	49	49	52	54	56	58	63	71	71	67
Above Normal (16%)	61	57	51	50	53	58	58	60	67	73	73	69
Below Normal (13%)	61	55	50	49	53	58	58	60	69	74	73	70
Dry (24%)	61	56	50	49	53	59	59	62	70	75	74	70
Critical (15%)	64	58	51	50	54	60	60	64	72	76	76	72

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-1.1	0.3	0.2	0.1	0.6	0.2	-3.5	0.3	0.3	0.1	0.3	0.6
0.2	-1.9	0.0	-0.1	0.0	0.3	0.2	-3.9	-0.9	0.4	0.2	0.3	0.4
0.3	-2.3	0.1	-0.1	0.1	0.1	0.5	-3.4	-1.1	0.4	0.3	0.1	0.2
0.4	-2.8	0.4	-0.4	0.0	0.2	0.5	-2.5	-0.7	0.5	0.1	0.1	0.3
0.5	-2.5	0.1	-0.1	0.0	0.4	0.6	-2.3	-1.1	0.4	0.3	0.1	0.3
0.6	-2.5	0.1	-0.1	0.0	0.4	0.5	-0.9	-1.3	0.0	0.1	0.0	0.4
0.7	-2.6	0.0	0.0	0.1	0.1	-0.4	-0.5	-0.8	1.7	0.2	0.0	0.3
0.8	-2.5	0.2	-0.2	0.1	0.1	-1.7	-0.4	-0.8	1.7	0.5	0.0	0.0
0.9	-2.5	0.0	-0.2	0.0	0.2	-2.1	-0.3	-0.6	2.4	-1.0	0.0	-0.2
Long Term												
Full Simulation Period ^b	-2.0	0.1	-0.1	0.0	0.3	-0.1	-1.9	-0.6	1.1	0.4	0.2	0.3
Water Year Types ^c												
Wet (32%)	-1.8	0.2	0.0	0.1	0.2	-0.9	-0.3	-0.8	2.5	0.7	0.3	0.4
Above Normal (16%)	-2.3	0.1	-0.1	0.1	0.3	0.0	-1.6	-0.8	0.5	0.1	0.0	0.2
Below Normal (13%)	-1.8	0.2	-0.1	0.1	0.4	0.4	-2.3	-0.6	0.9	0.3	0.1	0.3
Dry (24%)	-2.4	0.1	-0.1	0.0	0.4	0.5	-3.1	-0.5	0.1	0.1	0.2	0.4
Critical (15%)	-1.6	0.0	-0.3	-0.1	0.0	0.0	-3.5	-0.3	0.4	0.5	0.4	0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


B.20. Feather River Low Flow Channel

Figure B-20-1. Feather River Low Flow Channel, October

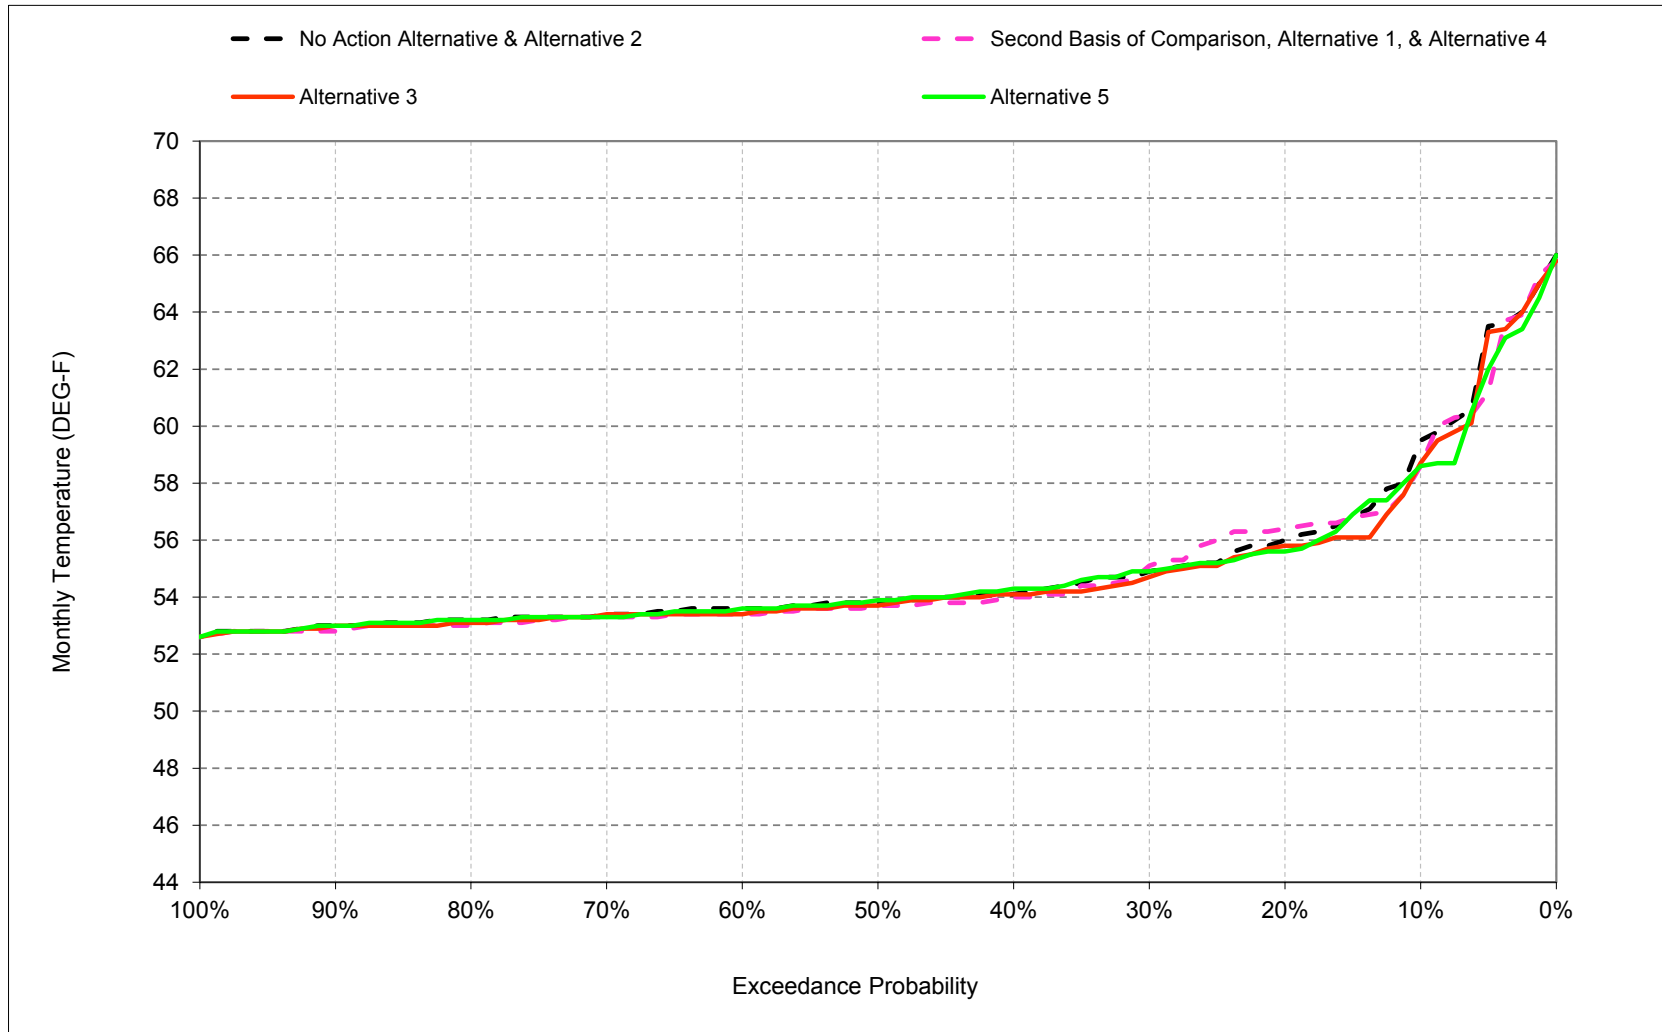


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-20-2. Feather River Low Flow Channel, November

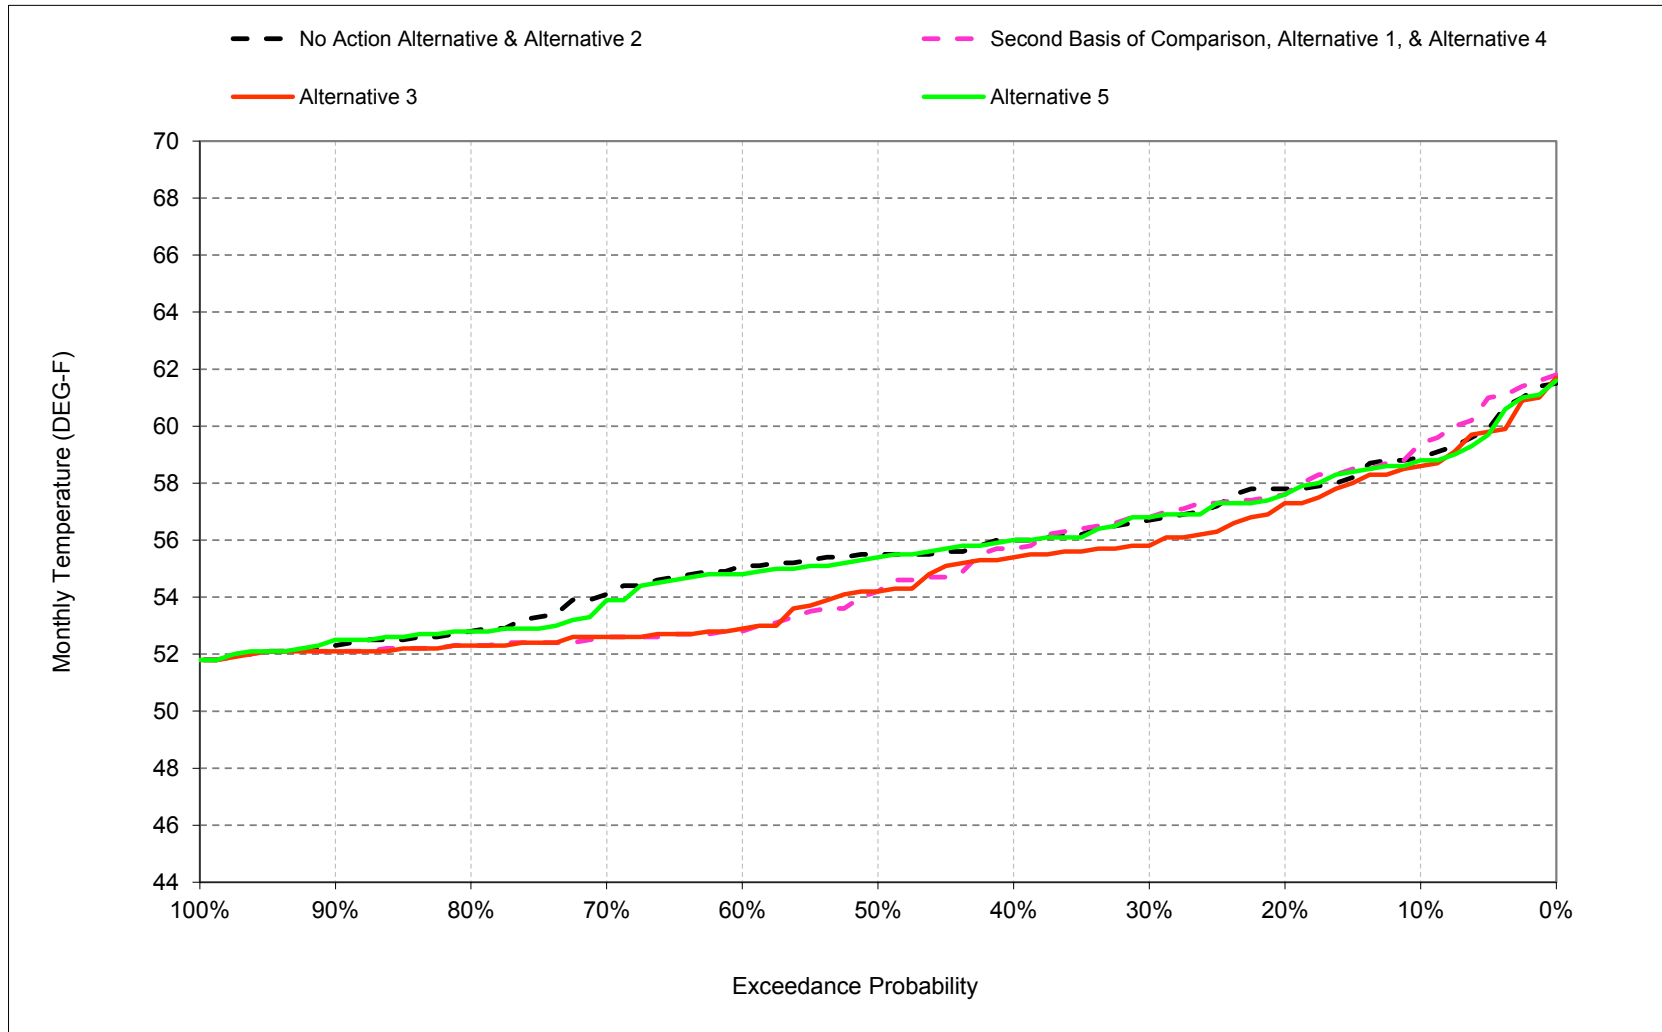


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-20-3. Feather River Low Flow Channel, December

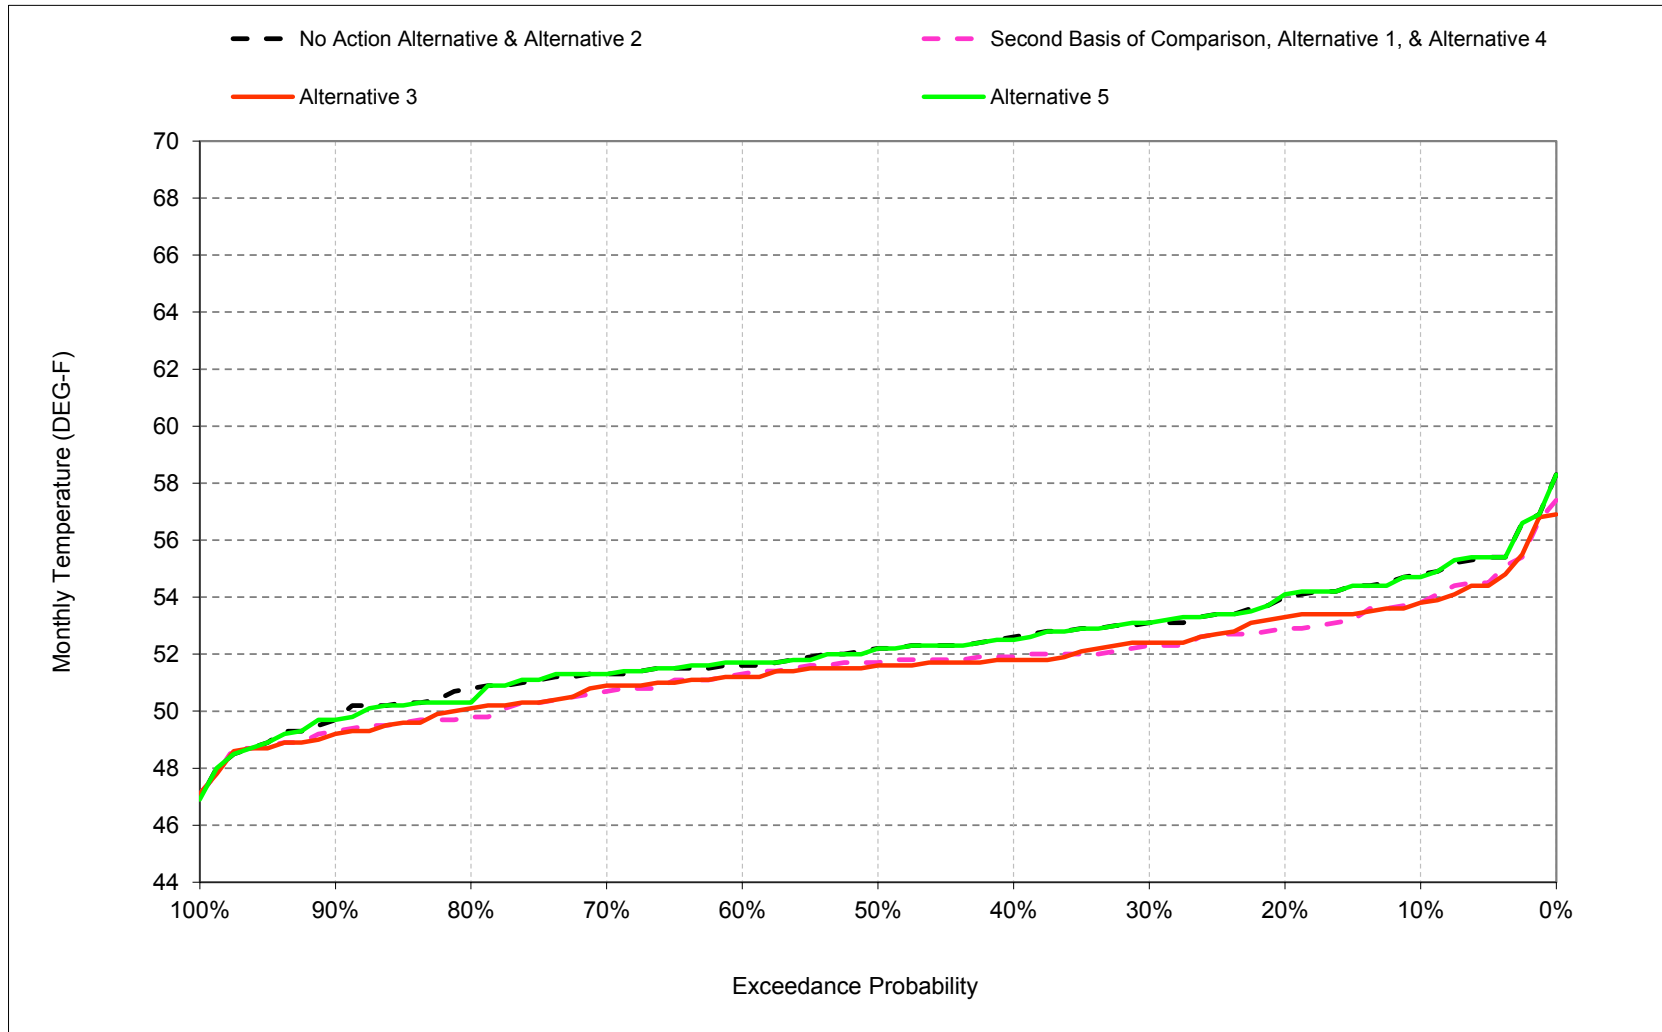


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-20-4. Feather River Low Flow Channel, January

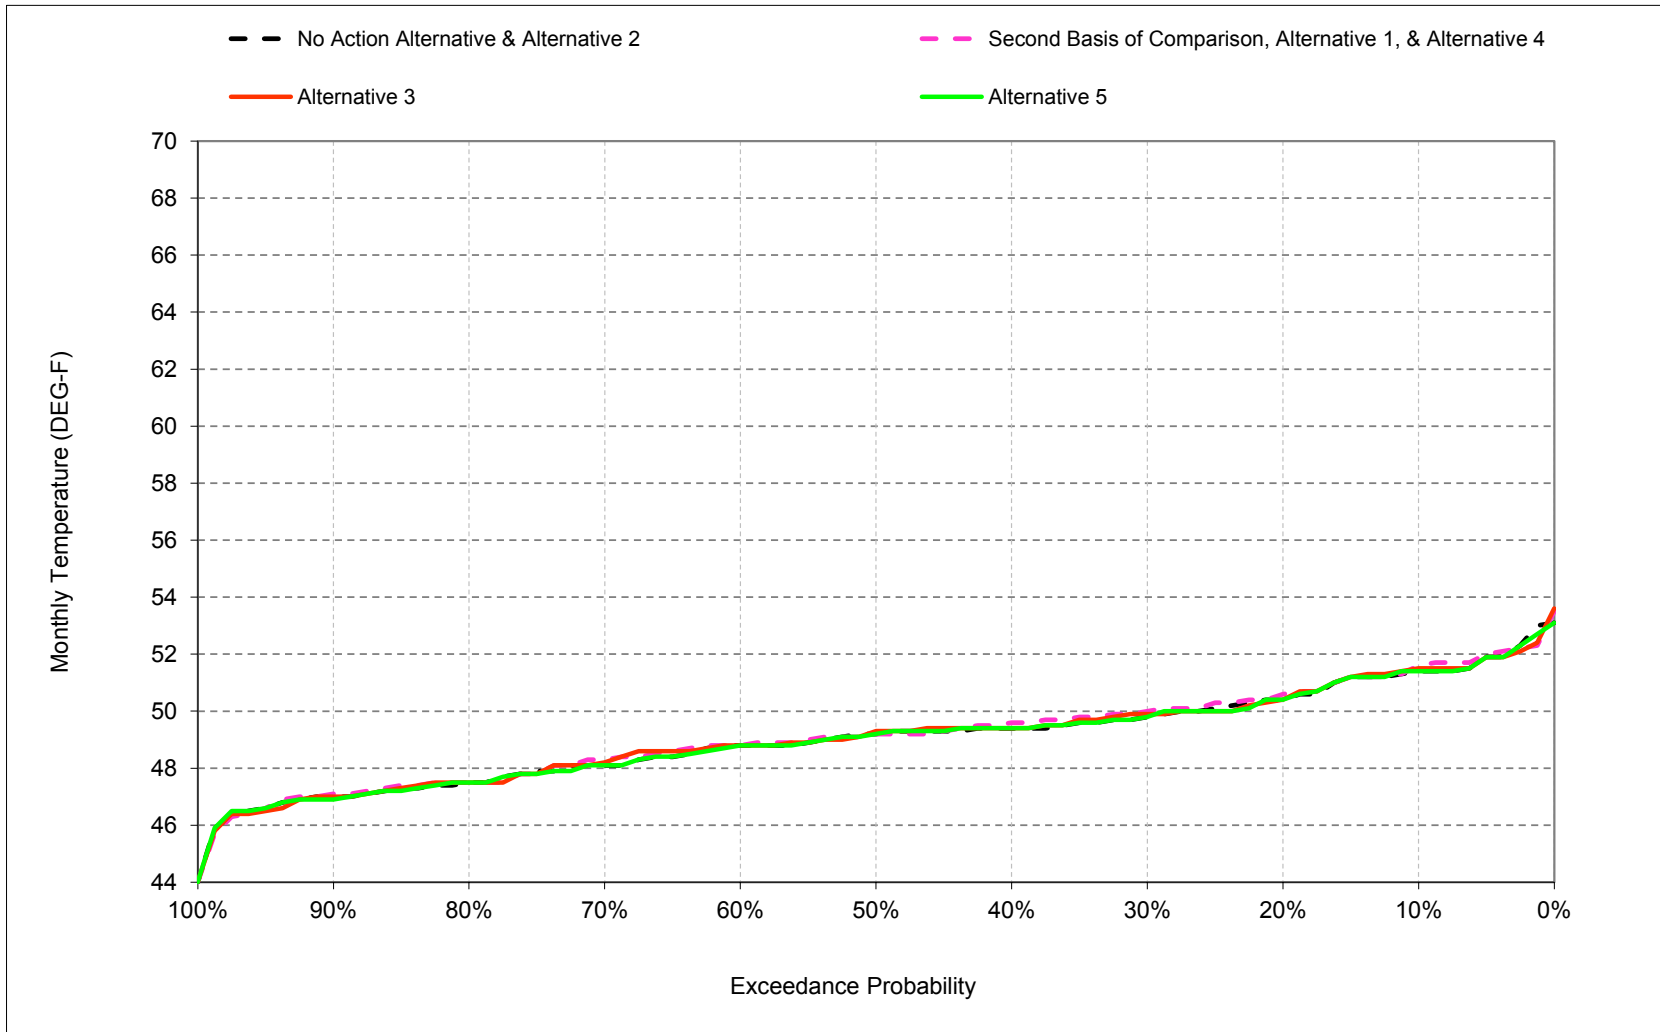


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-20-5. Feather River Low Flow Channel, February

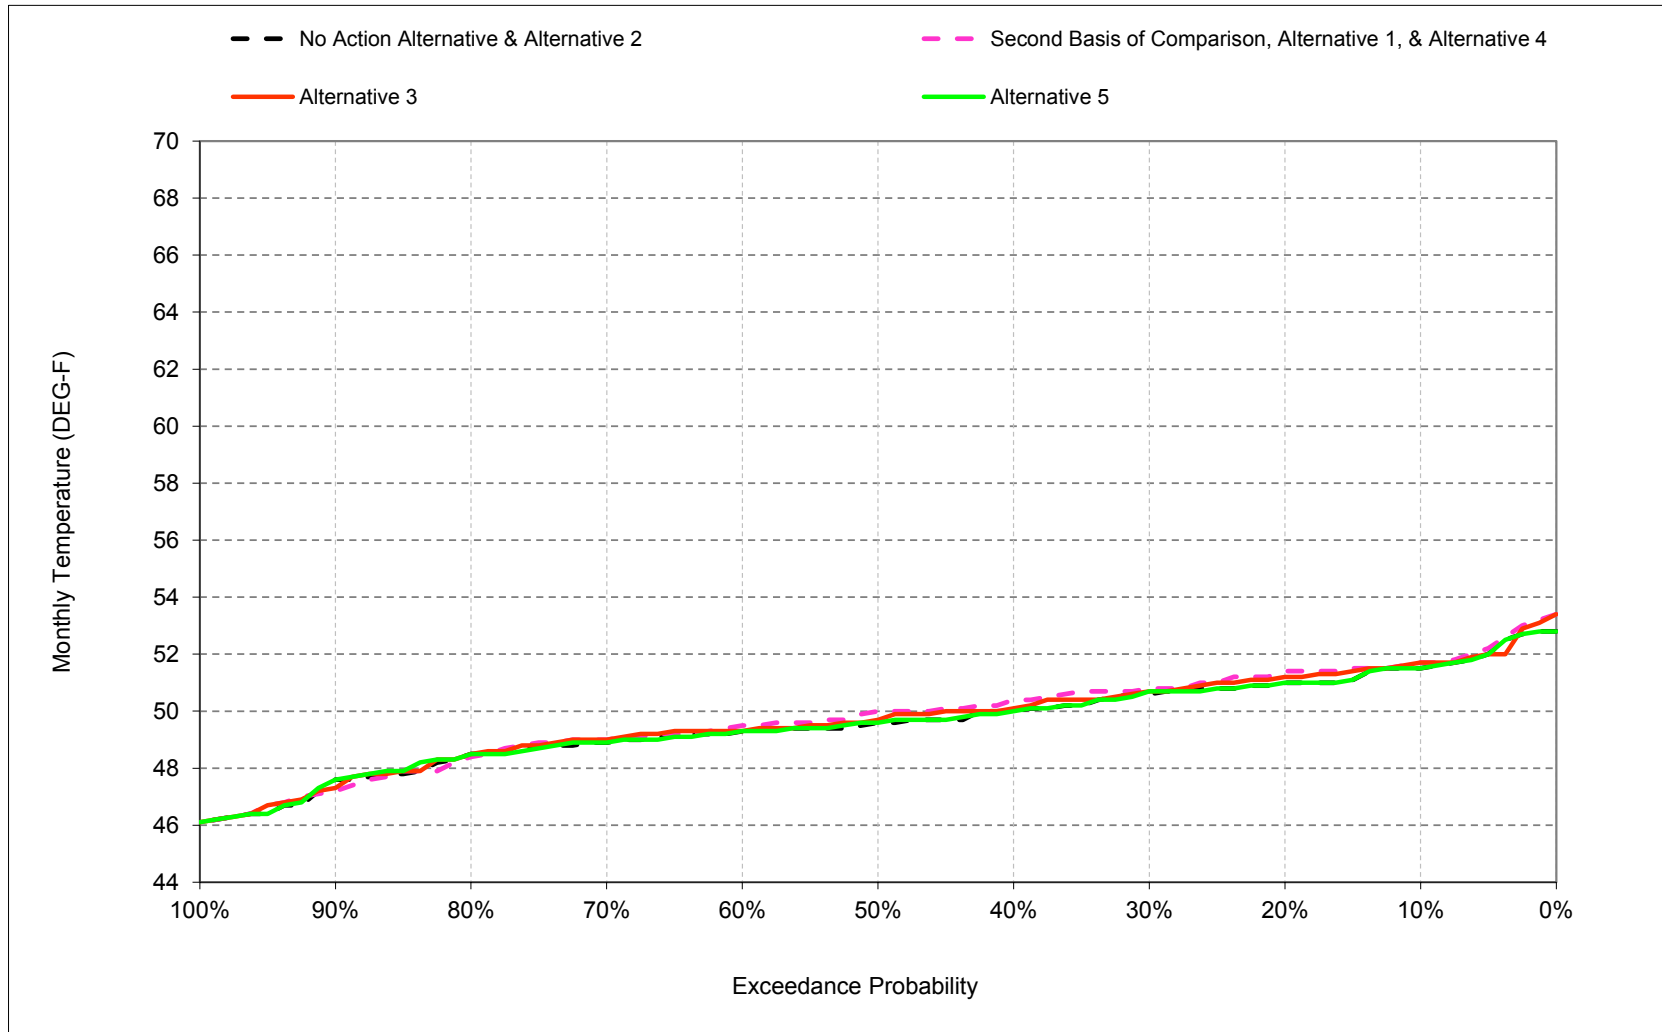


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-20-6. Feather River Low Flow Channel, March

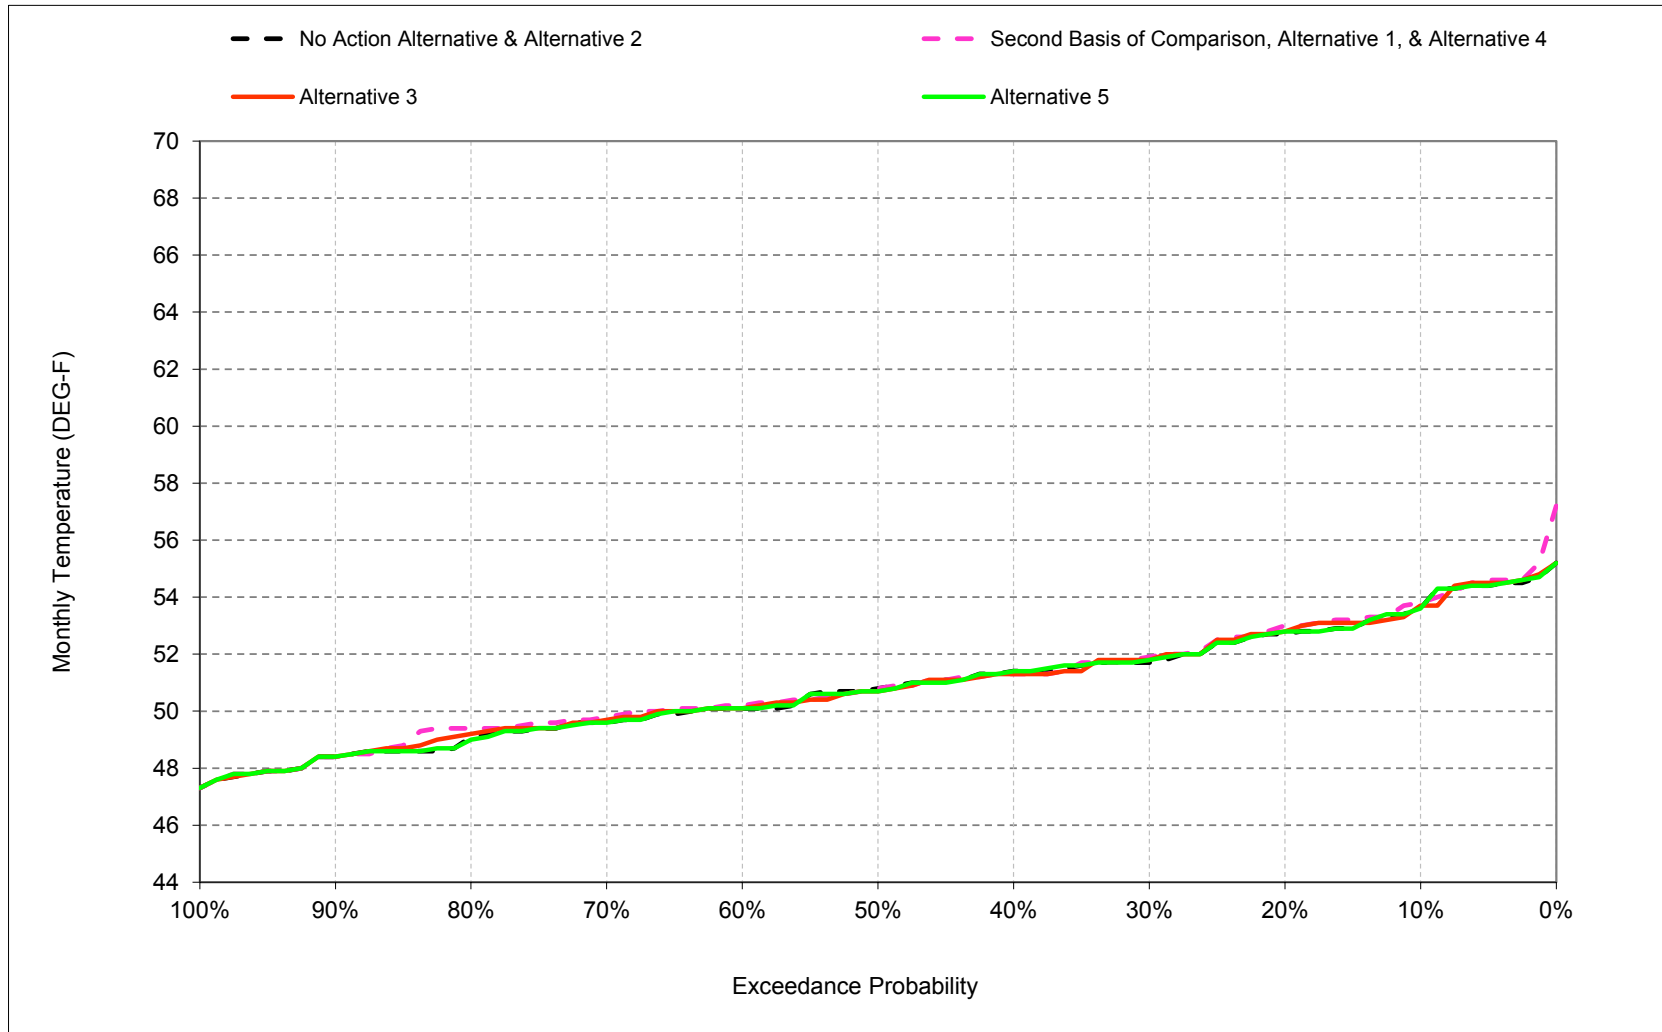


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-20-7. Feather River Low Flow Channel, April

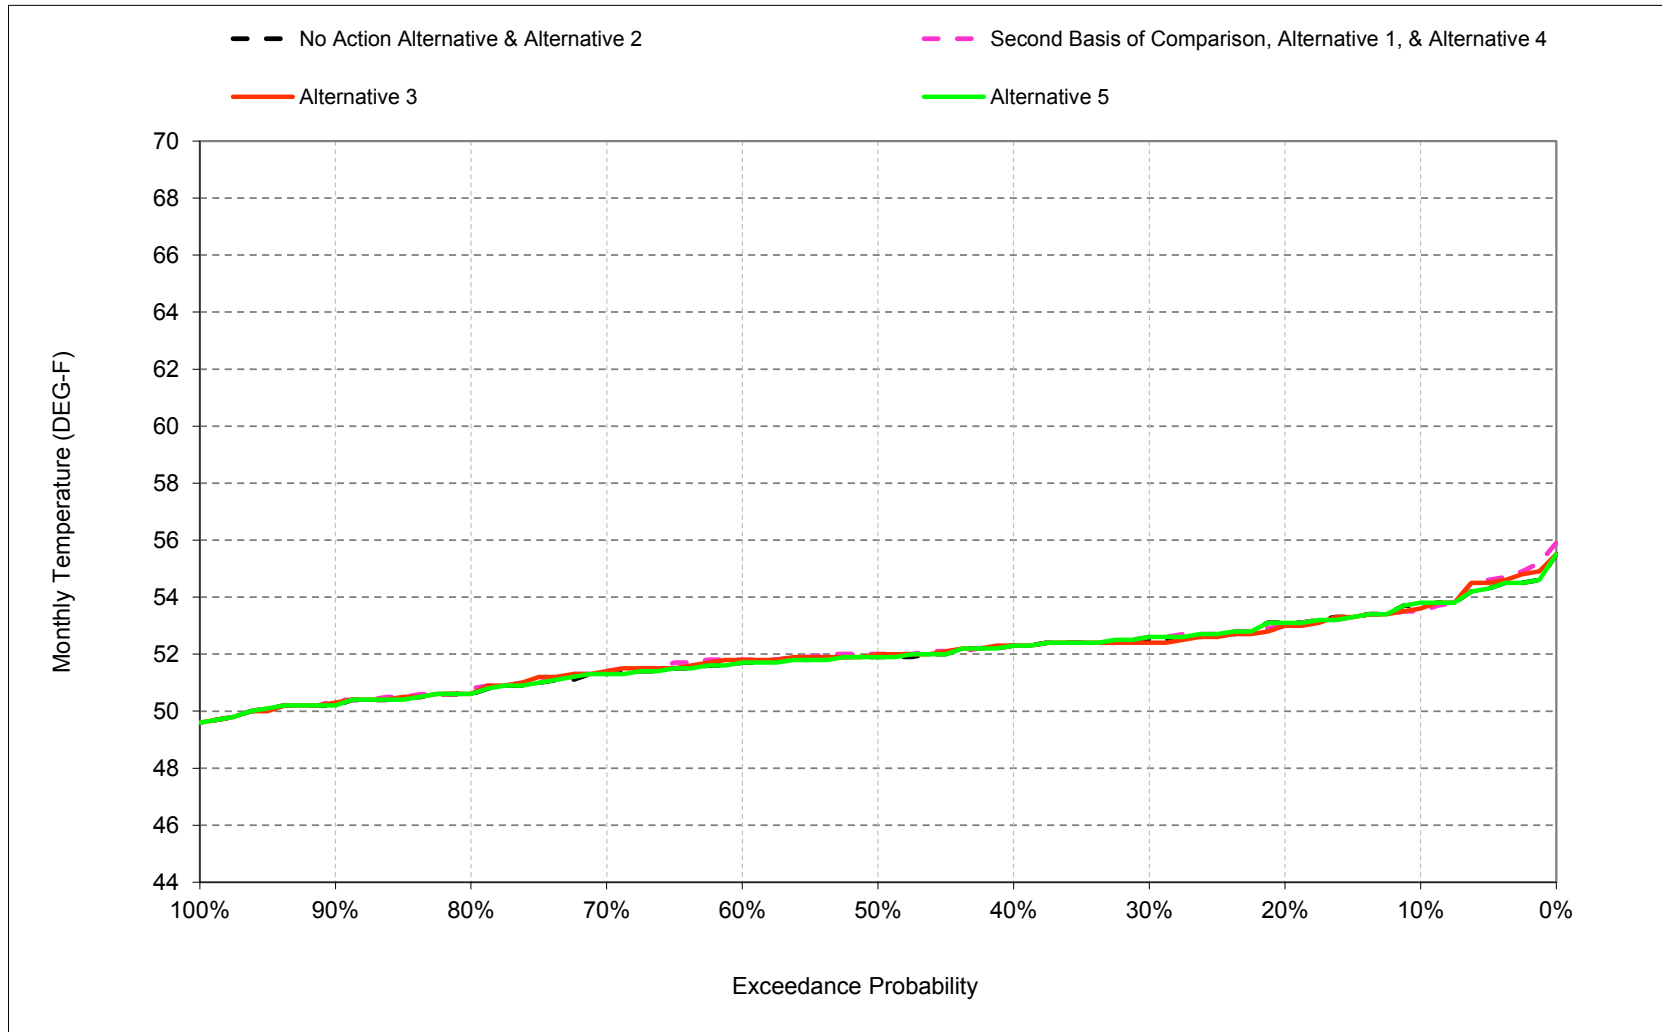


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-20-8. Feather River Low Flow Channel, May

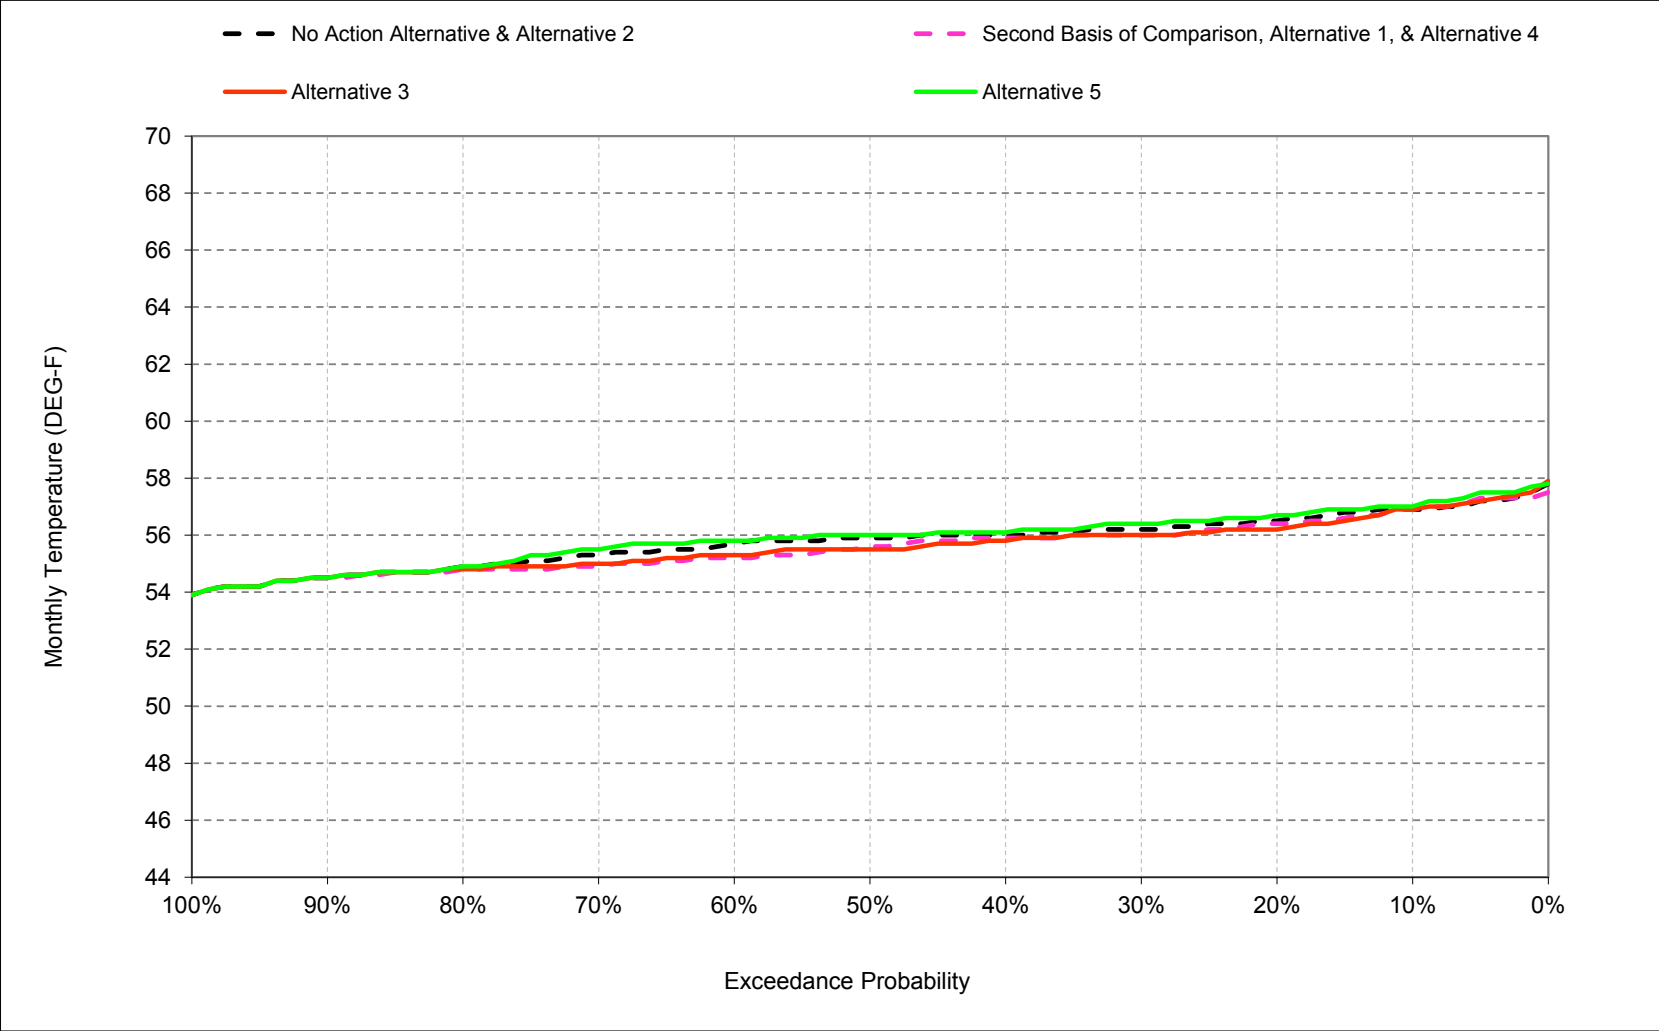


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-20-9. Feather River Low Flow Channel, June

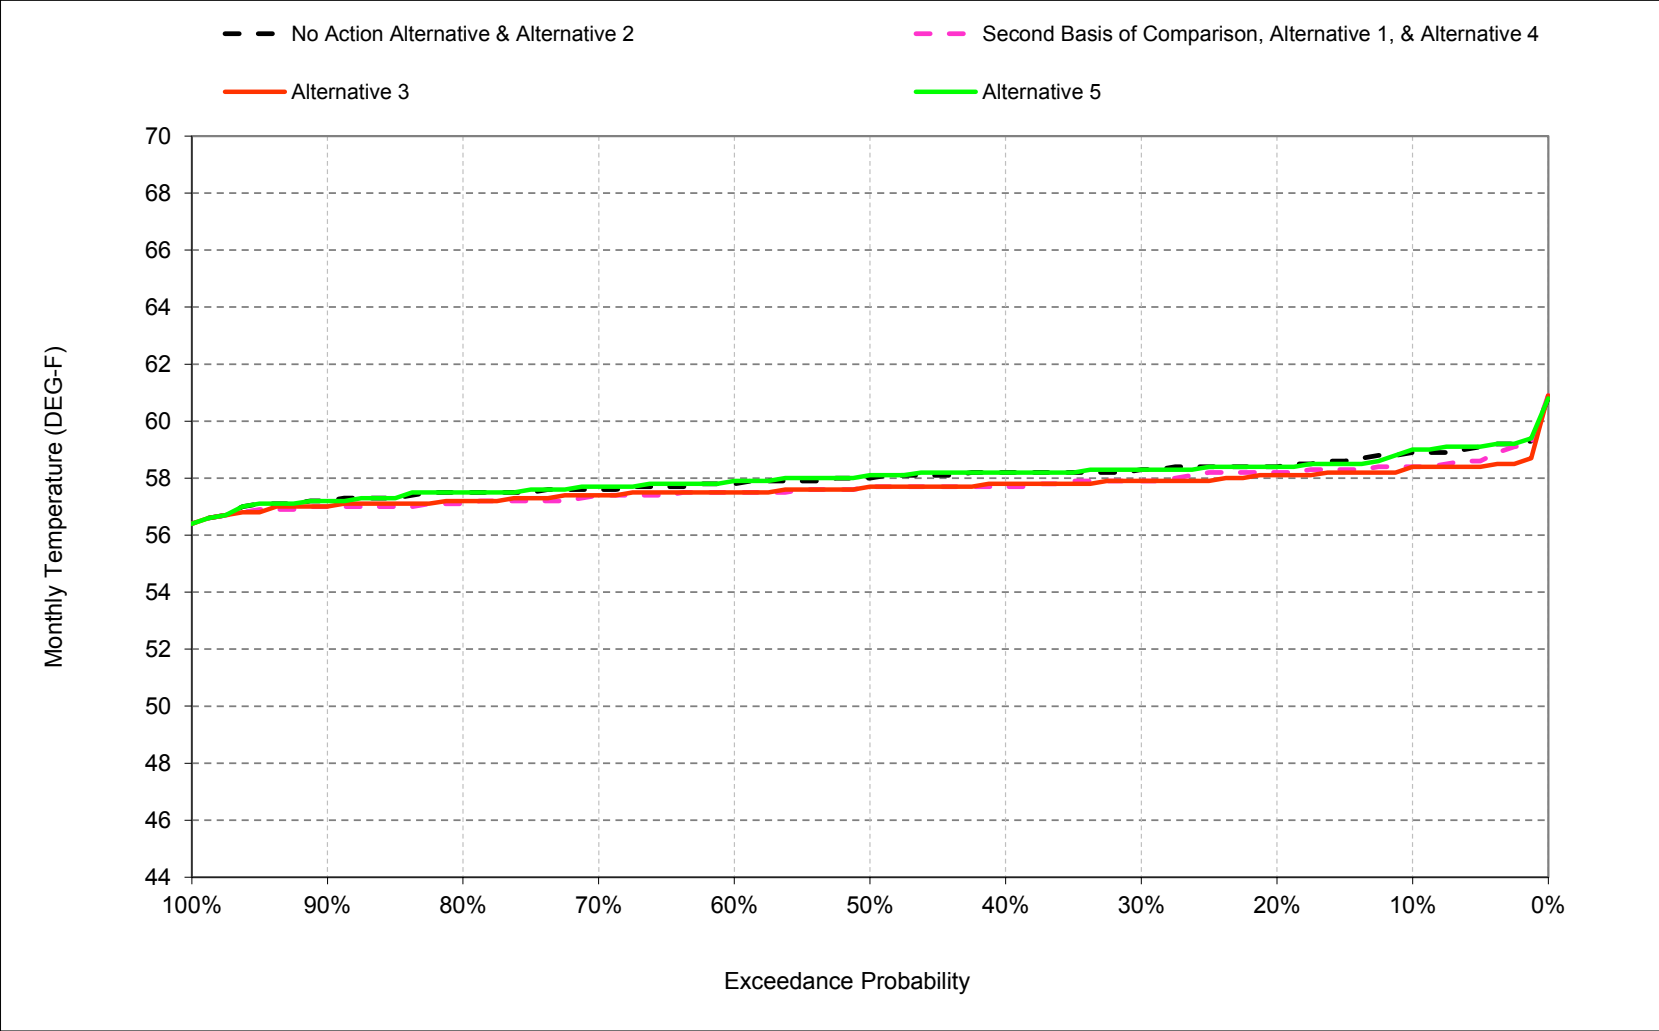


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-20-10. Feather River Low Flow Channel, July

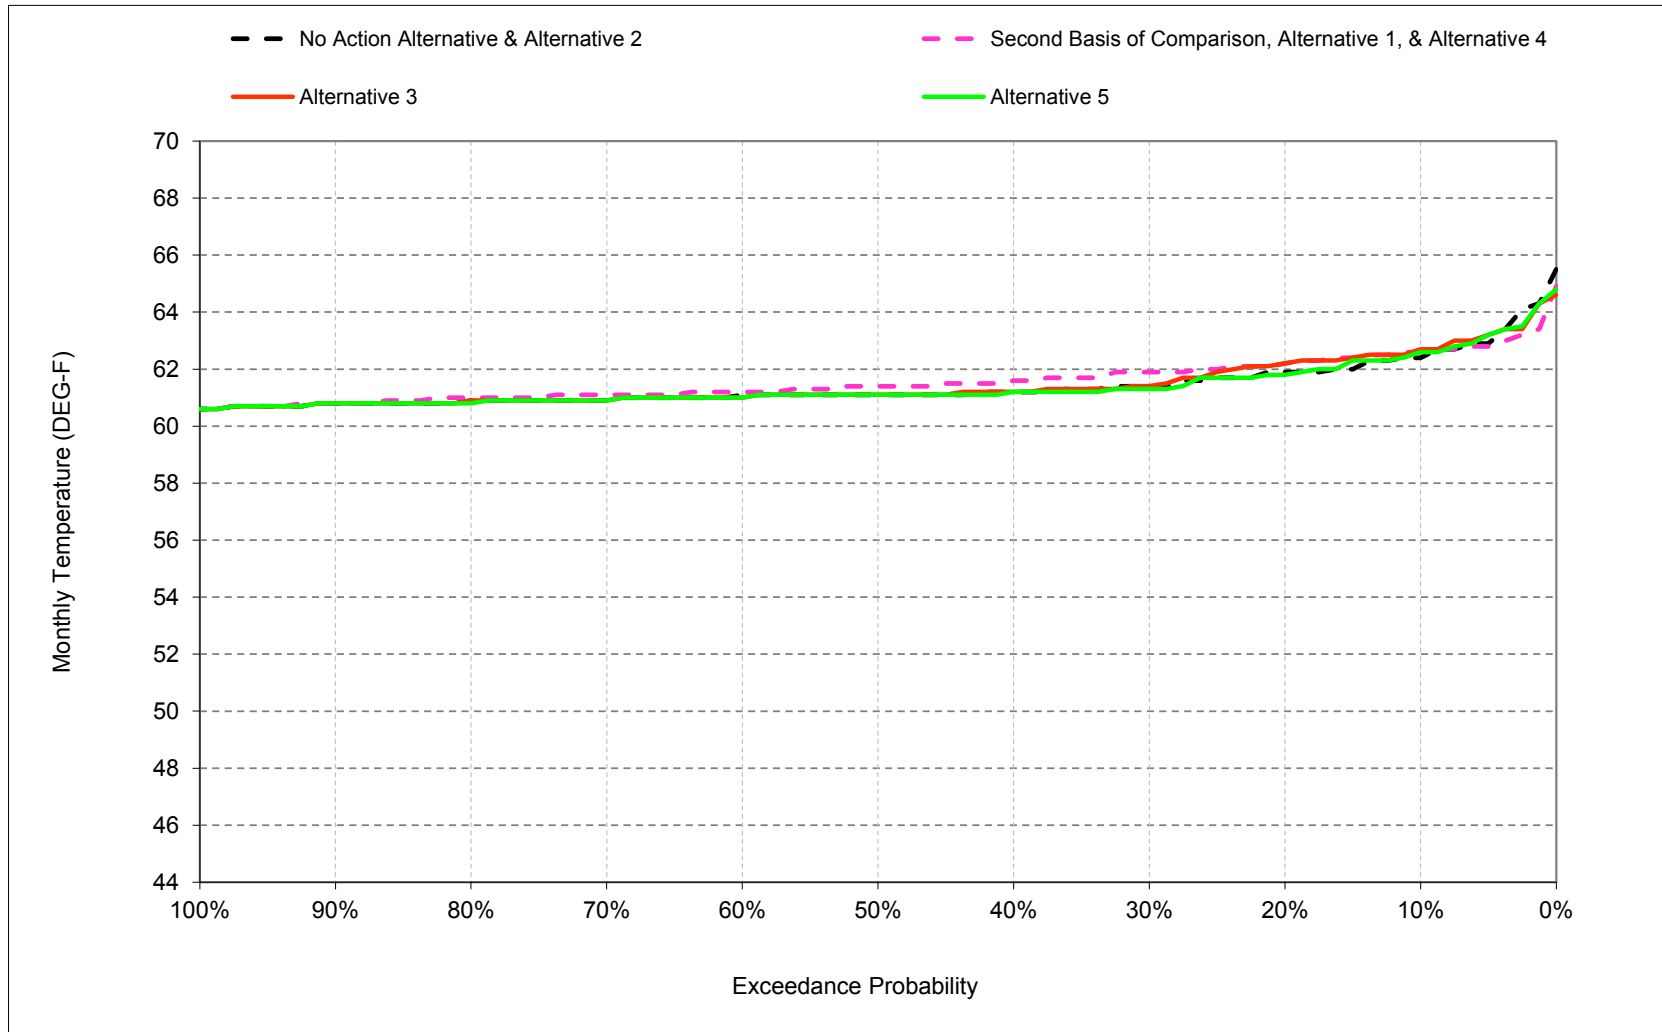


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-20-11. Feather River Low Flow Channel, August

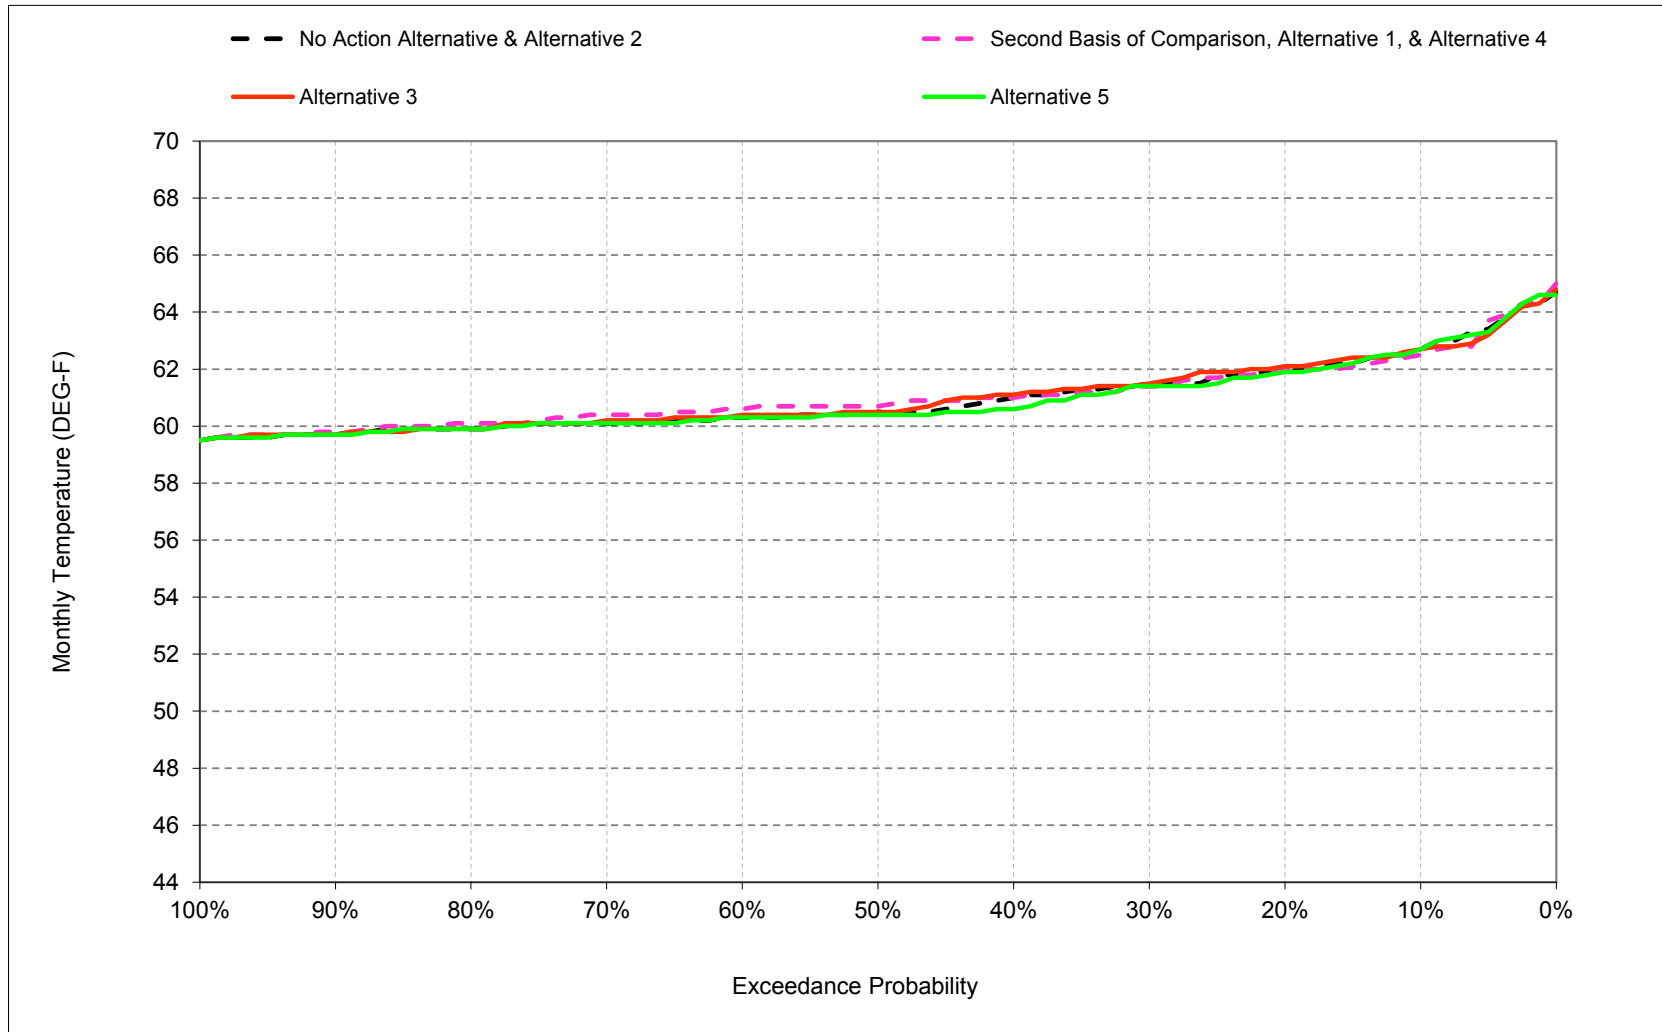

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-20-12. Feather River Low Flow Channel, September

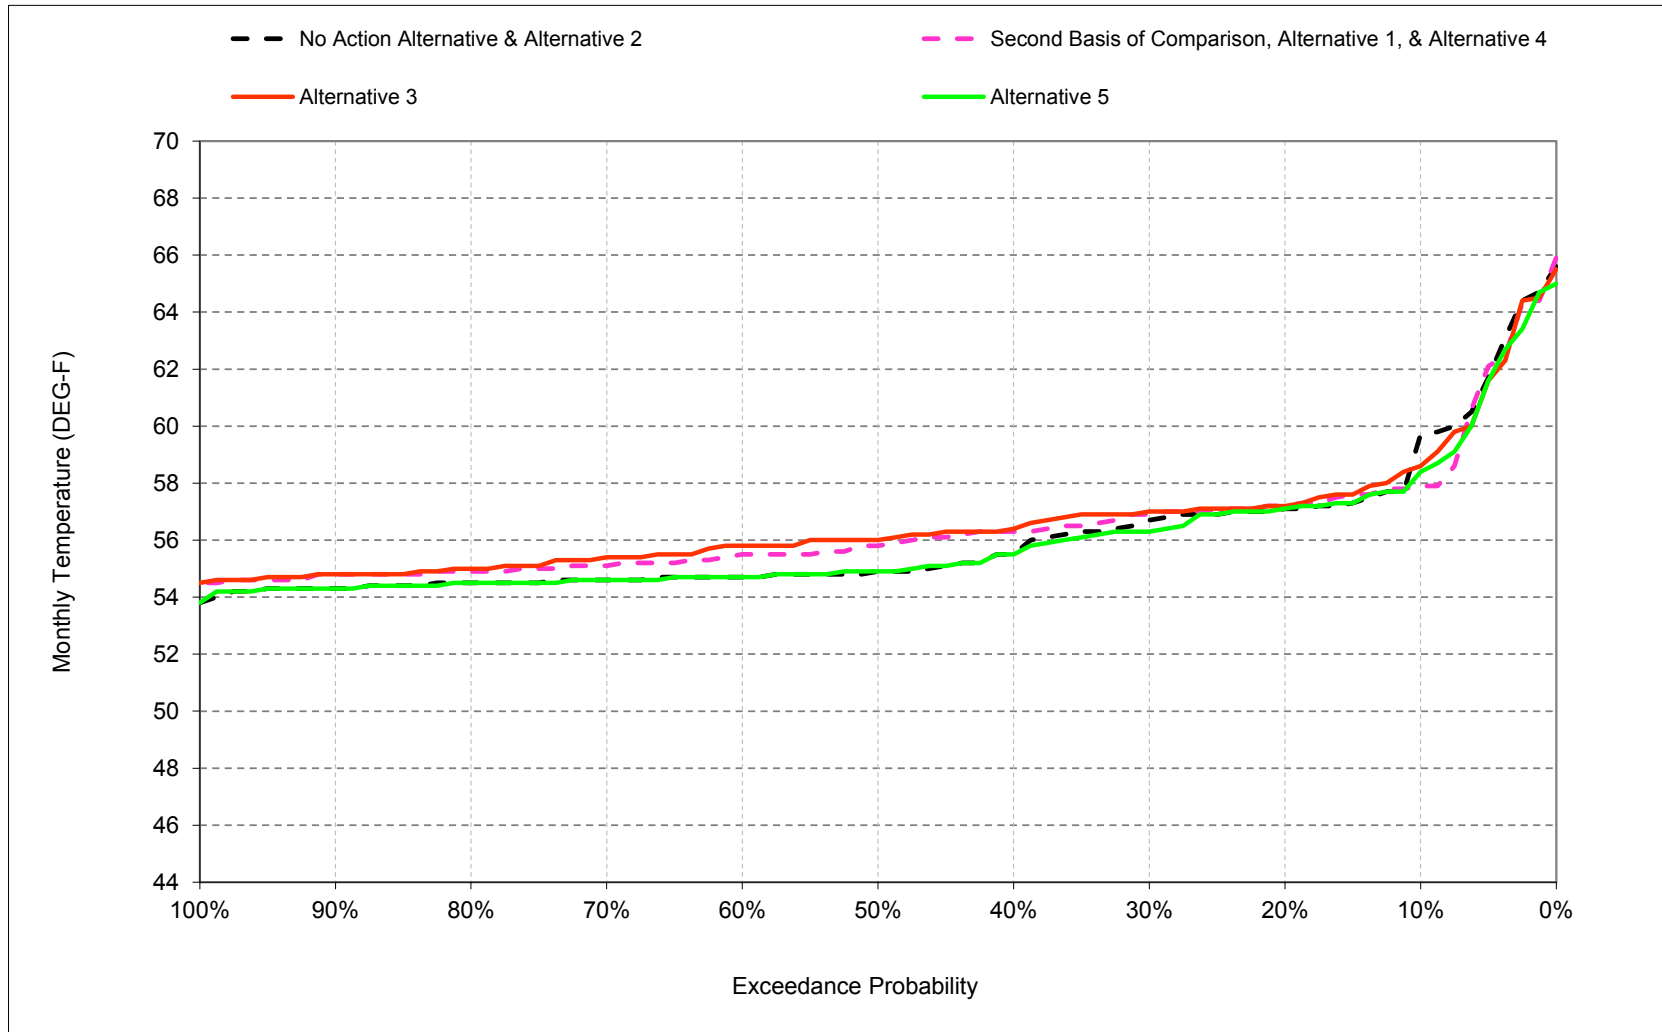

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-20-1. Feather River Low Flow Channel, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	60	59	55	51	52	54	54	57	59	62	63	60
20%	56	58	54	50	51	53	53	57	58	62	62	57
30%	55	57	53	50	51	52	53	56	58	61	62	57
40%	54	56	53	49	50	51	52	56	58	61	61	56
50%	54	56	52	49	50	51	52	56	58	61	61	55
60%	54	55	52	49	49	50	52	56	58	61	60	55
70%	53	54	51	48	49	50	51	55	58	61	60	55
80%	53	53	51	48	49	49	51	55	58	61	60	55
90%	53	52	50	47	48	48	50	55	57	61	60	54
Long Term												
Full Simulation Period ^b	55	56	52	49	50	51	52	56	58	61	61	56
Water Year Types ^c												
Wet (32%)	52	53	49	49	49	49	51	55	58	61	60	55
Above Normal (16%)	55	56	53	45	46	46	48	52	54	56	55	50
Below Normal (13%)	54	56	53	50	50	52	53	56	58	61	60	56
Dry (24%)	56	56	53	49	50	52	53	56	58	61	61	57
Critical (15%)	56	56	53	49	50	52	52	56	58	63	63	60

Alternative 1												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	59	59	54	52	52	54	54	57	58	63	63	58
20%	56	58	53	51	51	53	53	56	58	62	62	57
30%	55	57	52	50	51	52	53	56	58	62	61	57
40%	54	56	52	50	50	51	52	56	58	62	61	56
50%	54	54	52	49	50	51	52	56	58	61	61	56
60%	53	53	51	49	50	50	52	55	58	61	61	56
70%	53	53	51	48	49	50	51	55	57	61	60	55
80%	53	52	50	48	48	49	51	55	57	61	60	55
90%	53	52	49	47	47	48	50	55	57	61	60	55
Long Term												
Full Simulation Period ^b	55	55	52	49	50	51	52	56	58	62	61	56
Water Year Types ^c												
Wet (32%)	52	52	49	49	49	50	51	55	58	61	61	56
Above Normal (16%)	56	55	52	46	46	46	48	52	53	56	56	51
Below Normal (13%)	54	55	52	50	50	52	53	55	57	61	61	56
Dry (24%)	55	56	52	49	50	52	53	56	58	62	61	56
Critical (15%)	56	57	52	49	50	52	52	56	58	63	63	60

Alternative 1 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.9	0.5	-1.0	0.2	0.2	0.2	-0.2	0.0	-0.5	0.2	-0.2	-1.8
0.2	0.4	-0.2	-1.1	0.2	0.4	0.3	-0.1	-0.1	-0.2	0.3	0.1	0.1
0.3	0.2	0.1	-0.8	0.2	0.2	0.2	0.1	-0.2	-0.4	0.5	-0.1	0.2
0.4	-0.1	-0.3	-0.7	0.2	0.4	-0.1	0.0	-0.1	-0.5	0.4	0.0	0.8
0.5	-0.1	-1.3	-0.5	0.0	0.4	0.0	0.1	-0.3	-0.3	0.3	0.2	0.9
0.6	-0.2	-2.3	-0.3	0.0	0.2	0.1	0.1	-0.5	-0.3	0.1	0.3	0.8
0.7	-0.1	-1.5	-0.6	0.2	0.1	0.2	0.1	-0.4	-0.2	0.2	0.3	0.5
0.8	-0.2	-0.5	-1.0	0.0	-0.1	0.3	0.2	-0.1	-0.4	0.1	0.2	0.4
0.9	-0.2	-0.2	-0.4	0.1	-0.4	0.0	0.2	0.0	-0.2	0.0	0.1	0.5
Long Term												
Full Simulation Period ^b	-0.1	-0.5	-0.6	0.1	0.2	0.1	0.1	-0.2	-0.3	0.2	0.1	0.4
Water Year Types ^c												
Wet (32%)	-0.3	-1.0	-0.4	0.1	0.2	0.2	0.1	-0.1	-0.2	0.1	0.5	1.3
Above Normal (16%)	0.3	-0.3	-0.9	0.1	0.2	0.0	0.0	-0.4	-0.4	0.1	0.3	0.6
Below Normal (13%)	0.0	-1.2	-1.4	-0.1	0.0	0.0	0.1	-0.4	-0.7	0.2	0.4	0.0
Dry (24%)	-0.2	-0.4	-0.7	0.0	0.3	0.0	0.1	-0.2	-0.2	0.4	-0.6	-0.5
Critical (15%)	0.2	0.9	-0.2	0.1	0.1	0.4	-0.1	0.0	-0.3	0.0	-0.1	-0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-20-2. Feather River Low Flow Channel, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	60	59	55	51	52	54	54	57	59	62	63	60
20%	56	58	54	50	51	53	53	57	58	62	62	57
30%	55	57	53	50	51	52	53	56	58	61	62	57
40%	54	56	53	49	50	51	52	56	58	61	61	56
50%	54	56	52	49	50	51	52	56	58	61	61	55
60%	54	55	52	49	49	50	52	56	58	61	60	55
70%	53	54	51	48	49	50	51	55	58	61	60	55
80%	53	53	51	48	49	49	51	55	58	61	60	55
90%	53	52	50	47	48	48	50	55	57	61	60	54
Long Term												
Full Simulation Period ^b	55	56	52	49	50	51	52	56	58	61	61	56
Water Year Types ^c												
Wet (32%)	52	53	49	49	49	49	51	55	58	61	60	55
Above Normal (16%)	55	56	53	45	46	46	48	52	54	56	55	50
Below Normal (13%)	54	56	53	50	50	52	53	56	58	61	60	56
Dry (24%)	56	56	53	49	50	52	53	56	58	61	61	57
Critical (15%)	56	56	53	49	50	52	52	56	58	63	63	60

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	59	59	54	52	52	54	54	57	58	63	63	59
20%	56	57	53	50	51	53	53	56	58	62	62	57
30%	55	56	52	50	51	52	52	56	58	61	62	57
40%	54	55	52	49	50	51	52	56	58	61	61	56
50%	54	54	52	49	50	51	52	56	58	61	61	56
60%	53	53	51	49	49	50	52	55	58	61	60	56
70%	53	53	51	48	49	50	51	55	57	61	60	55
80%	53	52	50	48	49	49	51	55	57	61	60	55
90%	53	52	49	47	47	48	50	55	57	61	60	55
Long Term												
Full Simulation Period ^b	55	55	52	49	50	51	52	56	58	61	61	57
Water Year Types ^c												
Wet (32%)	52	52	49	49	49	50	51	55	57	61	61	56
Above Normal (16%)	55	55	52	46	46	46	48	52	53	56	55	51
Below Normal (13%)	54	54	51	50	50	52	53	56	58	61	60	56
Dry (24%)	56	55	52	49	50	52	53	56	58	62	61	57
Critical (15%)	56	56	52	49	50	52	52	56	58	63	63	60

Alternative 3 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.8	-0.3	-1.0	0.1	0.2	0.1	-0.1	0.0	-0.5	0.3	0.0	-1.1
0.2	-0.2	-0.5	-0.7	0.0	0.2	0.1	-0.1	-0.3	-0.3	0.3	0.2	0.1
0.3	-0.2	-0.9	-0.7	0.1	0.1	0.1	-0.1	-0.2	-0.4	0.0	0.0	0.3
0.4	0.0	-0.6	-0.8	0.0	0.1	-0.1	0.0	-0.2	-0.4	0.0	0.1	0.9
0.5	-0.1	-1.3	-0.6	0.1	0.1	-0.1	0.1	-0.4	-0.3	0.0	0.0	1.1
0.6	-0.2	-2.2	-0.4	0.0	0.0	0.0	0.1	-0.4	-0.3	-0.1	0.1	1.1
0.7	0.0	-1.5	-0.4	0.1	0.1	0.1	0.1	-0.3	-0.2	0.0	0.1	0.8
0.8	-0.1	-0.5	-0.7	0.0	0.0	0.1	0.0	-0.1	-0.3	0.0	0.0	0.5
0.9	0.0	-0.2	-0.5	0.0	-0.3	0.0	0.1	0.0	-0.2	0.0	0.0	0.5
Long Term												
Full Simulation Period ^b	-0.2	-0.8	-0.6	0.0	0.1	0.0	0.0	-0.2	-0.3	0.0	0.0	0.5
Water Year Types ^c												
Wet (32%)	-0.2	-1.0	-0.4	0.1	0.2	0.1	0.1	-0.1	-0.3	0.0	0.3	1.5
Above Normal (16%)	-0.2	-0.7	-0.7	0.1	0.1	0.0	-0.1	-0.3	-0.3	0.0	0.1	0.6
Below Normal (13%)	0.0	-1.3	-1.6	-0.1	0.0	0.0	0.0	-0.3	-0.4	-0.1	-0.2	0.3
Dry (24%)	0.0	-0.7	-0.6	0.0	0.1	0.1	0.1	-0.2	-0.3	0.2	-0.1	-0.2
Critical (15%)	-0.4	-0.1	-0.3	0.0	0.1	-0.1	0.0	0.1	-0.3	0.0	-0.1	-0.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-20-3. Feather River Low Flow Channel, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	60	59	55	51	52	54	54	57	59	62	63	60
20%	56	58	54	50	51	53	53	57	58	62	62	57
30%	55	57	53	50	51	52	53	56	58	61	62	57
40%	54	56	53	49	50	51	52	56	58	61	61	56
50%	54	56	52	49	50	51	52	56	58	61	61	55
60%	54	55	52	49	49	50	52	56	58	61	60	55
70%	53	54	51	48	49	50	51	55	58	61	60	55
80%	53	53	51	48	49	49	51	55	58	61	60	55
90%	53	52	50	47	48	48	50	55	57	61	60	54
Long Term												
Full Simulation Period ^b	55	56	52	49	50	51	52	56	58	61	61	56
Water Year Types ^c												
Wet (32%)	52	53	49	49	49	49	51	55	58	61	60	55
Above Normal (16%)	55	56	53	45	46	46	48	52	54	56	55	50
Below Normal (13%)	54	56	53	50	50	52	53	56	58	61	60	56
Dry (24%)	56	56	53	49	50	52	53	56	58	61	61	57
Critical (15%)	56	56	53	49	50	52	52	56	58	63	63	60

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	59	59	55	51	52	54	54	57	59	63	63	58
20%	56	58	54	50	51	53	53	57	58	62	62	57
30%	55	57	53	50	51	52	53	56	58	61	61	56
40%	54	56	53	49	50	51	52	56	58	61	61	56
50%	54	55	52	49	50	51	52	56	58	61	60	55
60%	54	55	52	49	49	50	52	56	58	61	60	55
70%	53	54	51	48	49	50	51	56	58	61	60	55
80%	53	53	50	48	49	49	51	55	58	61	60	55
90%	53	53	50	47	48	48	50	55	57	61	60	54
Long Term												
Full Simulation Period ^b	55	55	52	49	50	51	52	56	58	61	61	56
Water Year Types ^c												
Wet (32%)	52	53	49	49	49	49	51	55	58	61	60	55
Above Normal (16%)	55	56	53	45	46	46	48	52	54	56	55	50
Below Normal (13%)	54	56	53	50	50	52	53	56	58	61	60	56
Dry (24%)	55	56	53	49	50	52	53	56	58	61	61	57
Critical (15%)	56	56	53	49	50	52	53	57	59	63	63	60

Alternative 5 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.9	-0.1	-0.1	0.0	0.0	0.0	0.1	0.1	0.1	0.2	0.0	-1.3
0.2	-0.4	-0.2	0.1	0.0	0.0	0.1	0.0	0.2	0.0	-0.1	0.0	0.0
0.3	0.0	0.1	0.0	0.0	0.1	0.1	0.1	0.2	0.0	-0.1	-0.1	-0.4
0.4	0.2	0.0	-0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-0.4	0.0
0.5	0.1	-0.1	0.0	0.0	0.0	-0.1	0.0	0.1	0.1	0.0	-0.1	0.0
0.6	0.0	-0.3	0.1	0.0	0.0	0.0	0.0	0.1	0.1	-0.1	0.0	0.0
0.7	-0.1	-0.2	0.0	0.0	0.0	0.0	0.0	0.2	0.1	0.0	0.0	0.0
0.8	0.0	0.0	-0.5	0.0	0.0	-0.1	0.0	0.0	0.0	-0.1	0.0	0.0
0.9	0.0	0.2	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	-0.1	-0.1
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Above Normal (16%)	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0
Below Normal (13%)	-0.2	-0.2	0.0	0.0	0.1	0.0	0.0	0.2	0.1	0.0	-0.1	-0.1
Dry (24%)	-0.2	-0.3	0.0	0.0	0.0	0.0	0.0	0.3	0.0	0.0	-0.1	-0.1
Critical (15%)	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.2	0.1	-0.1	-0.1	-0.5

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-20-4. Feather River Low Flow Channel, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	59	59	54	52	52	54	54	57	58	63	63	58
20%	56	58	53	51	51	53	53	56	58	62	62	57
30%	55	57	52	50	51	52	53	56	58	62	61	57
40%	54	56	52	50	50	51	52	56	58	62	61	56
50%	54	54	52	49	50	51	52	56	58	61	61	56
60%	53	53	51	49	50	50	52	55	58	61	61	56
70%	53	53	51	48	49	50	51	55	57	61	60	55
80%	53	52	50	48	48	49	51	55	57	61	60	55
90%	53	52	49	47	47	48	50	55	57	61	60	55
Long Term												
Full Simulation Period ^b	55	55	52	49	50	51	52	56	58	62	61	56
Water Year Types ^c												
Wet (32%)	52	52	49	49	49	50	51	55	58	61	61	56
Above Normal (16%)	56	55	52	46	46	46	48	52	53	56	56	51
Below Normal (13%)	54	55	52	50	50	52	53	55	57	61	61	56
Dry (24%)	55	56	52	49	50	52	53	56	58	62	61	56
Critical (15%)	56	57	52	49	50	52	52	56	58	63	63	60

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	60	59	55	51	52	54	54	57	59	62	63	60
20%	56	58	54	50	51	53	53	57	58	62	62	57
30%	55	57	53	50	51	52	53	56	58	61	62	57
40%	54	56	53	49	50	51	52	56	58	61	61	56
50%	54	56	52	49	50	51	52	56	58	61	61	55
60%	54	55	52	49	49	50	52	56	58	61	60	55
70%	53	54	51	48	49	50	51	55	58	61	60	55
80%	53	53	51	48	49	49	51	55	58	61	60	55
90%	53	52	50	47	48	48	50	55	57	61	60	54
Long Term												
Full Simulation Period ^b	55	56	52	49	50	51	52	56	58	61	61	56
Water Year Types ^c												
Wet (32%)	52	53	49	49	49	49	51	55	58	61	60	55
Above Normal (16%)	55	56	53	45	46	46	48	52	54	56	55	50
Below Normal (13%)	54	56	53	50	50	52	53	56	58	61	60	56
Dry (24%)	56	56	53	49	50	52	53	56	58	61	61	57
Critical (15%)	56	56	53	49	50	52	52	56	58	63	63	60

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.9	-0.5	1.0	-0.2	-0.2	-0.2	0.2	0.0	0.5	-0.2	0.2	1.8
0.2	-0.4	0.2	1.1	-0.2	-0.4	-0.3	0.1	0.1	0.2	-0.3	-0.1	-0.1
0.3	-0.2	-0.1	0.8	-0.2	-0.2	-0.2	-0.1	0.2	0.4	-0.5	0.1	-0.2
0.4	0.1	0.3	0.7	-0.2	-0.4	0.1	0.0	0.1	0.5	-0.4	0.0	-0.8
0.5	0.1	1.3	0.5	0.0	-0.4	0.0	-0.1	0.3	0.3	-0.3	-0.2	-0.9
0.6	0.2	2.3	0.3	0.0	-0.2	-0.1	-0.1	0.5	0.3	-0.1	-0.3	-0.8
0.7	0.1	1.5	0.6	-0.2	-0.1	-0.2	-0.1	0.4	0.2	-0.2	-0.3	-0.5
0.8	0.2	0.5	1.0	0.0	0.1	-0.3	-0.2	0.1	0.4	-0.1	-0.2	-0.4
0.9	0.2	0.2	0.4	-0.1	0.4	0.0	-0.2	0.0	0.2	0.0	-0.1	-0.5
Long Term												
Full Simulation Period ^b	0.1	0.5	0.6	-0.1	-0.2	-0.1	-0.1	0.2	0.3	-0.2	-0.1	-0.4
Water Year Types ^c												
Wet (32%)	0.3	1.0	0.4	-0.1	-0.2	-0.2	-0.1	0.1	0.2	-0.1	-0.5	-1.3
Above Normal (16%)	-0.3	0.3	0.9	-0.1	-0.2	0.0	0.0	0.4	0.4	-0.1	-0.3	-0.6
Below Normal (13%)	0.0	1.2	1.4	0.1	0.0	0.0	-0.1	0.4	0.7	-0.2	-0.4	0.0
Dry (24%)	0.2	0.4	0.7	0.0	-0.3	0.0	-0.1	0.2	0.2	-0.4	0.6	0.5
Critical (15%)	-0.2	-0.9	0.2	-0.1	-0.1	-0.4	0.1	0.0	0.3	0.0	0.1	0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-20-5. Feather River Low Flow Channel, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	59	59	54	52	52	54	54	57	58	63	63	58
20%	56	58	53	51	51	53	53	56	58	62	62	57
30%	55	57	52	50	51	52	53	56	58	62	61	57
40%	54	56	52	50	50	51	52	56	58	62	61	56
50%	54	54	52	49	50	51	52	56	58	61	61	56
60%	53	53	51	49	50	50	52	55	58	61	61	56
70%	53	53	51	48	49	50	51	55	57	61	60	55
80%	53	52	50	48	48	49	51	55	57	61	60	55
90%	53	52	49	47	47	48	50	55	57	61	60	55
Long Term												
Full Simulation Period ^b	55	55	52	49	50	51	52	56	58	62	61	56
Water Year Types ^c												
Wet (32%)	52	52	49	49	49	50	51	55	58	61	61	56
Above Normal (16%)	56	55	52	46	46	46	48	52	53	56	56	51
Below Normal (13%)	54	55	52	50	50	52	53	55	57	61	61	56
Dry (24%)	55	56	52	49	50	52	53	56	58	62	61	56
Critical (15%)	56	57	52	49	50	52	52	56	58	63	63	60

Alternative 3

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	59	59	54	52	52	54	54	57	58	63	63	59
20%	56	57	53	50	51	53	53	56	58	62	62	57
30%	55	56	52	50	51	52	52	56	58	61	62	57
40%	54	55	52	49	50	51	52	56	58	61	61	56
50%	54	54	52	49	50	51	52	56	58	61	61	56
60%	53	53	51	49	49	50	52	55	58	61	60	56
70%	53	53	51	48	49	50	51	55	57	61	60	55
80%	53	52	50	48	49	49	51	55	57	61	60	55
90%	53	52	49	47	47	48	50	55	57	61	60	55
Long Term												
Full Simulation Period ^b	55	55	52	49	50	51	52	56	58	61	61	57
Water Year Types ^c												
Wet (32%)	52	52	49	49	49	50	51	55	57	61	61	56
Above Normal (16%)	55	55	52	46	46	46	48	52	53	56	55	51
Below Normal (13%)	54	54	51	50	50	52	53	56	58	61	60	56
Dry (24%)	56	55	52	49	50	52	53	56	58	62	61	57
Critical (15%)	56	56	52	49	50	52	52	56	58	63	63	60

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.1	-0.8	0.0	-0.1	0.0	-0.1	0.1	0.0	0.0	0.1	0.2	0.7
0.2	-0.6	-0.3	0.4	-0.2	-0.2	-0.2	0.0	-0.2	-0.1	0.0	0.1	0.0
0.3	-0.4	-1.0	0.1	-0.1	-0.1	-0.1	-0.2	0.0	0.0	-0.5	0.1	0.1
0.4	0.1	-0.3	-0.1	-0.2	-0.3	0.0	0.0	-0.1	0.1	-0.4	0.1	0.1
0.5	0.0	0.0	-0.1	0.1	-0.3	-0.1	0.0	-0.1	0.0	-0.3	-0.2	0.2
0.6	0.0	0.1	-0.1	0.0	-0.2	-0.1	0.0	0.1	0.0	-0.2	-0.2	0.3
0.7	0.1	0.0	0.2	-0.1	0.0	-0.1	0.0	0.1	0.0	-0.2	-0.2	0.3
0.8	0.1	0.0	0.3	0.0	0.1	-0.2	-0.2	0.0	0.1	-0.1	-0.2	0.1
0.9	0.2	0.0	-0.1	-0.1	0.1	0.0	-0.1	0.0	0.0	0.0	-0.1	0.0
Long Term												
Full Simulation Period ^b	-0.1	-0.3	0.0	-0.1	-0.1	-0.1	0.0	0.0	0.0	-0.1	0.0	0.2
Water Year Types ^c												
Wet (32%)	0.1	0.1	0.0	-0.1	0.0	-0.1	0.0	0.0	-0.1	-0.1	-0.2	0.2
Above Normal (16%)	-0.5	-0.4	0.2	-0.1	-0.1	0.0	-0.1	0.0	0.1	-0.1	-0.2	0.0
Below Normal (13%)	0.0	0.0	-0.2	0.0	0.0	0.0	0.0	0.1	0.2	-0.2	-0.7	0.3
Dry (24%)	0.2	-0.3	0.1	0.0	-0.2	0.0	-0.1	-0.1	-0.1	-0.2	0.5	0.3
Critical (15%)	-0.5	-1.0	-0.1	-0.1	0.0	-0.5	0.0	0.1	0.0	0.0	0.0	-0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-20-6. Feather River Low Flow Channel, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	59	59	54	52	52	54	54	57	58	63	63	58
20%	56	58	53	51	51	53	53	56	58	62	62	57
30%	55	57	52	50	51	52	53	56	58	62	61	57
40%	54	56	52	50	50	51	52	56	58	62	61	56
50%	54	54	52	49	50	51	52	56	58	61	61	56
60%	53	53	51	49	50	50	52	55	58	61	61	56
70%	53	53	51	48	49	50	51	55	57	61	60	55
80%	53	52	50	48	48	49	51	55	57	61	60	55
90%	53	52	49	47	47	48	50	55	57	61	60	55
Long Term												
Full Simulation Period ^b	55	55	52	49	50	51	52	56	58	62	61	56
Water Year Types ^c												
Wet (32%)	52	52	49	49	49	50	51	55	58	61	61	56
Above Normal (16%)	56	55	52	46	46	46	48	52	53	56	56	51
Below Normal (13%)	54	55	52	50	50	52	53	55	57	61	61	56
Dry (24%)	55	56	52	49	50	52	53	56	58	62	61	56
Critical (15%)	56	57	52	49	50	52	52	56	58	63	63	60

Alternative 5

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	59	59	55	51	52	54	54	57	59	63	63	58
20%	56	58	54	50	51	53	53	57	58	62	62	57
30%	55	57	53	50	51	52	53	56	58	61	61	56
40%	54	56	53	49	50	51	52	56	58	61	61	56
50%	54	55	52	49	50	51	52	56	58	61	60	55
60%	54	55	52	49	49	50	52	56	58	61	60	55
70%	53	54	51	48	49	50	51	56	58	61	60	55
80%	53	53	50	48	49	49	51	55	58	61	60	55
90%	53	53	50	47	48	48	50	55	57	61	60	54
Long Term												
Full Simulation Period ^b	55	55	52	49	50	51	52	56	58	61	61	56
Water Year Types ^c												
Wet (32%)	52	53	49	49	49	49	51	55	58	61	60	55
Above Normal (16%)	55	56	53	45	46	46	48	52	54	56	55	50
Below Normal (13%)	54	56	53	50	50	52	53	56	58	61	60	56
Dry (24%)	55	56	53	49	50	52	53	56	58	61	61	57
Critical (15%)	56	56	53	49	50	52	53	57	59	63	63	60

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.0	-0.6	0.9	-0.2	-0.2	-0.2	0.3	0.1	0.6	0.0	0.2	0.5
0.2	-0.8	0.0	1.2	-0.2	-0.4	-0.2	0.1	0.3	0.2	-0.4	-0.1	-0.1
0.3	-0.2	0.0	0.8	-0.2	-0.1	-0.1	0.0	0.4	0.4	-0.6	0.0	-0.6
0.4	0.3	0.3	0.6	-0.2	-0.4	0.1	0.0	0.2	0.5	-0.4	-0.4	-0.8
0.5	0.2	1.2	0.5	0.0	-0.4	-0.1	-0.1	0.4	0.4	-0.3	-0.3	-0.9
0.6	0.2	2.0	0.4	0.0	-0.2	-0.1	-0.1	0.6	0.4	-0.2	-0.3	-0.8
0.7	0.0	1.3	0.6	-0.2	-0.1	-0.2	-0.1	0.6	0.3	-0.2	-0.3	-0.5
0.8	0.2	0.5	0.5	0.0	0.1	-0.4	-0.2	0.1	0.4	-0.2	-0.2	-0.4
0.9	0.2	0.4	0.4	-0.2	0.4	0.0	-0.2	0.0	0.2	0.0	-0.1	-0.5
Long Term												
Full Simulation Period ^b	0.0	0.4	0.6	-0.1	-0.2	-0.1	-0.1	0.3	0.3	-0.2	-0.2	-0.5
Water Year Types ^c												
Wet (32%)	0.3	1.1	0.4	-0.2	-0.2	-0.2	-0.1	0.1	0.2	-0.1	-0.5	-1.2
Above Normal (16%)	-0.4	0.2	0.8	-0.2	-0.2	0.0	0.0	0.4	0.4	-0.1	-0.3	-0.6
Below Normal (13%)	-0.2	1.0	1.5	0.1	0.1	0.0	-0.1	0.6	0.7	-0.2	-0.6	-0.1
Dry (24%)	0.1	0.2	0.7	0.0	-0.3	0.0	-0.1	0.4	0.2	-0.4	0.6	0.4
Critical (15%)	-0.3	-1.0	0.2	-0.1	-0.1	-0.4	0.1	0.2	0.3	0.0	0.0	-0.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


B.21. Feather River at Robinson Riffle

Figure B-21-1. Feather River at Robinson Riffle, October

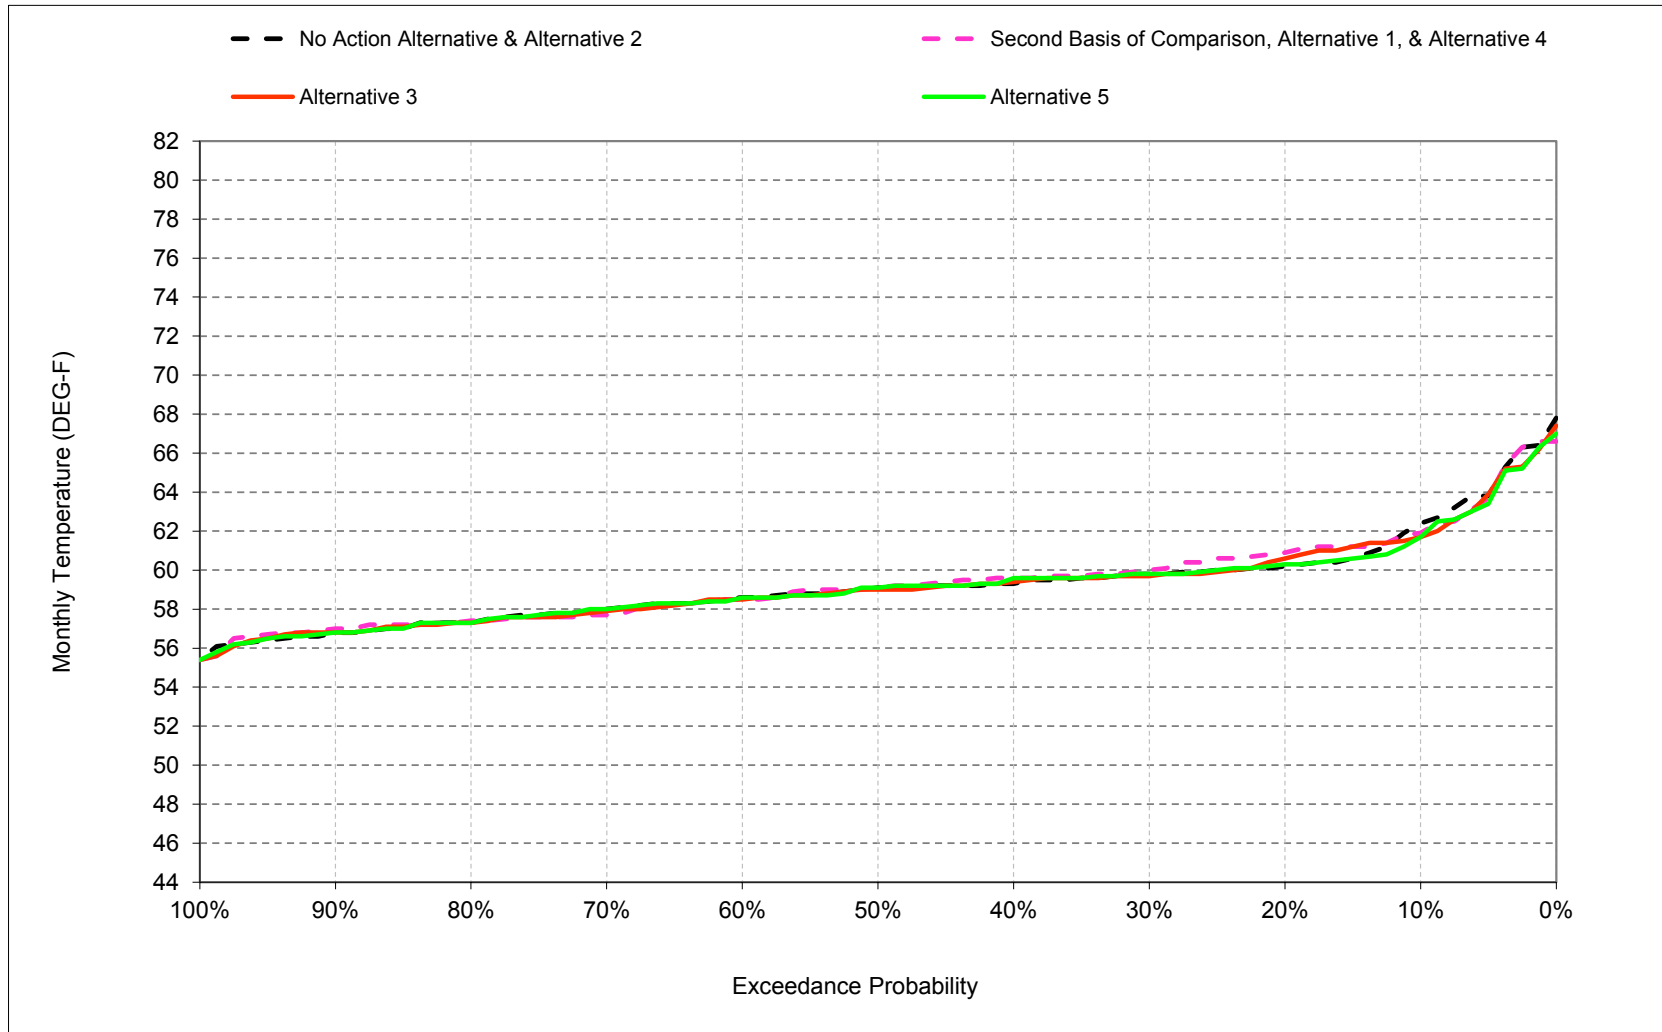


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-21-2. Feather River at Robinson Riffle, November

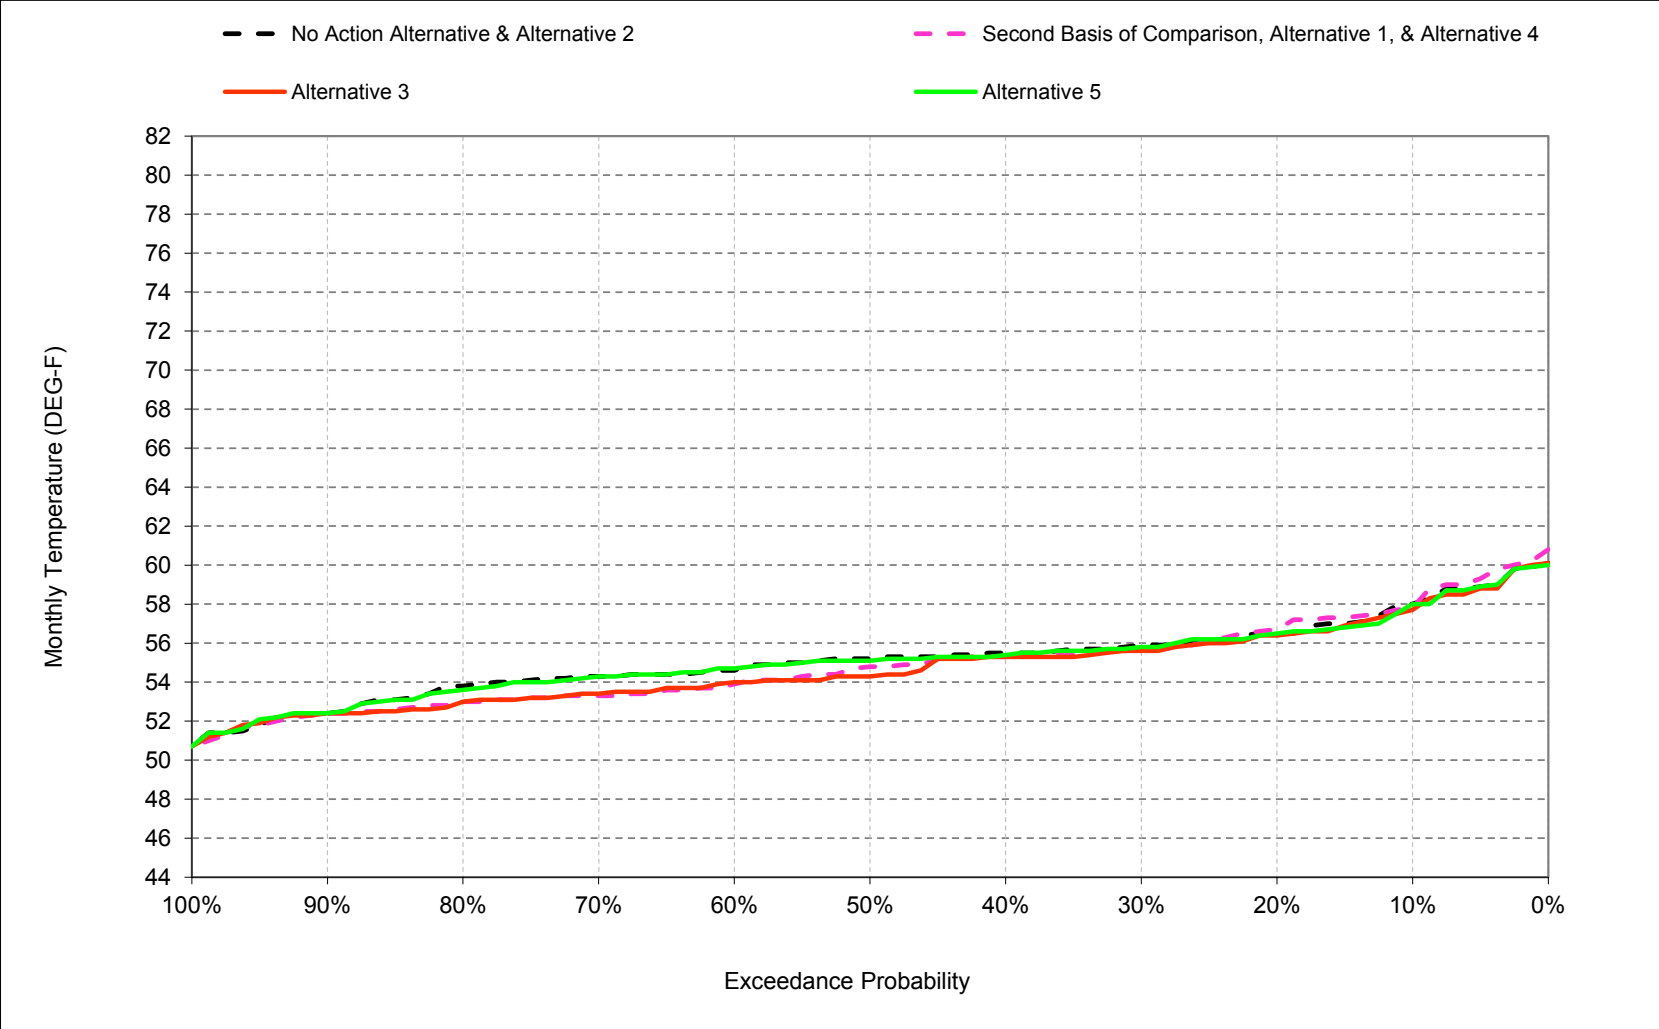


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-21-3. Feather River at Robinson Riffle, December

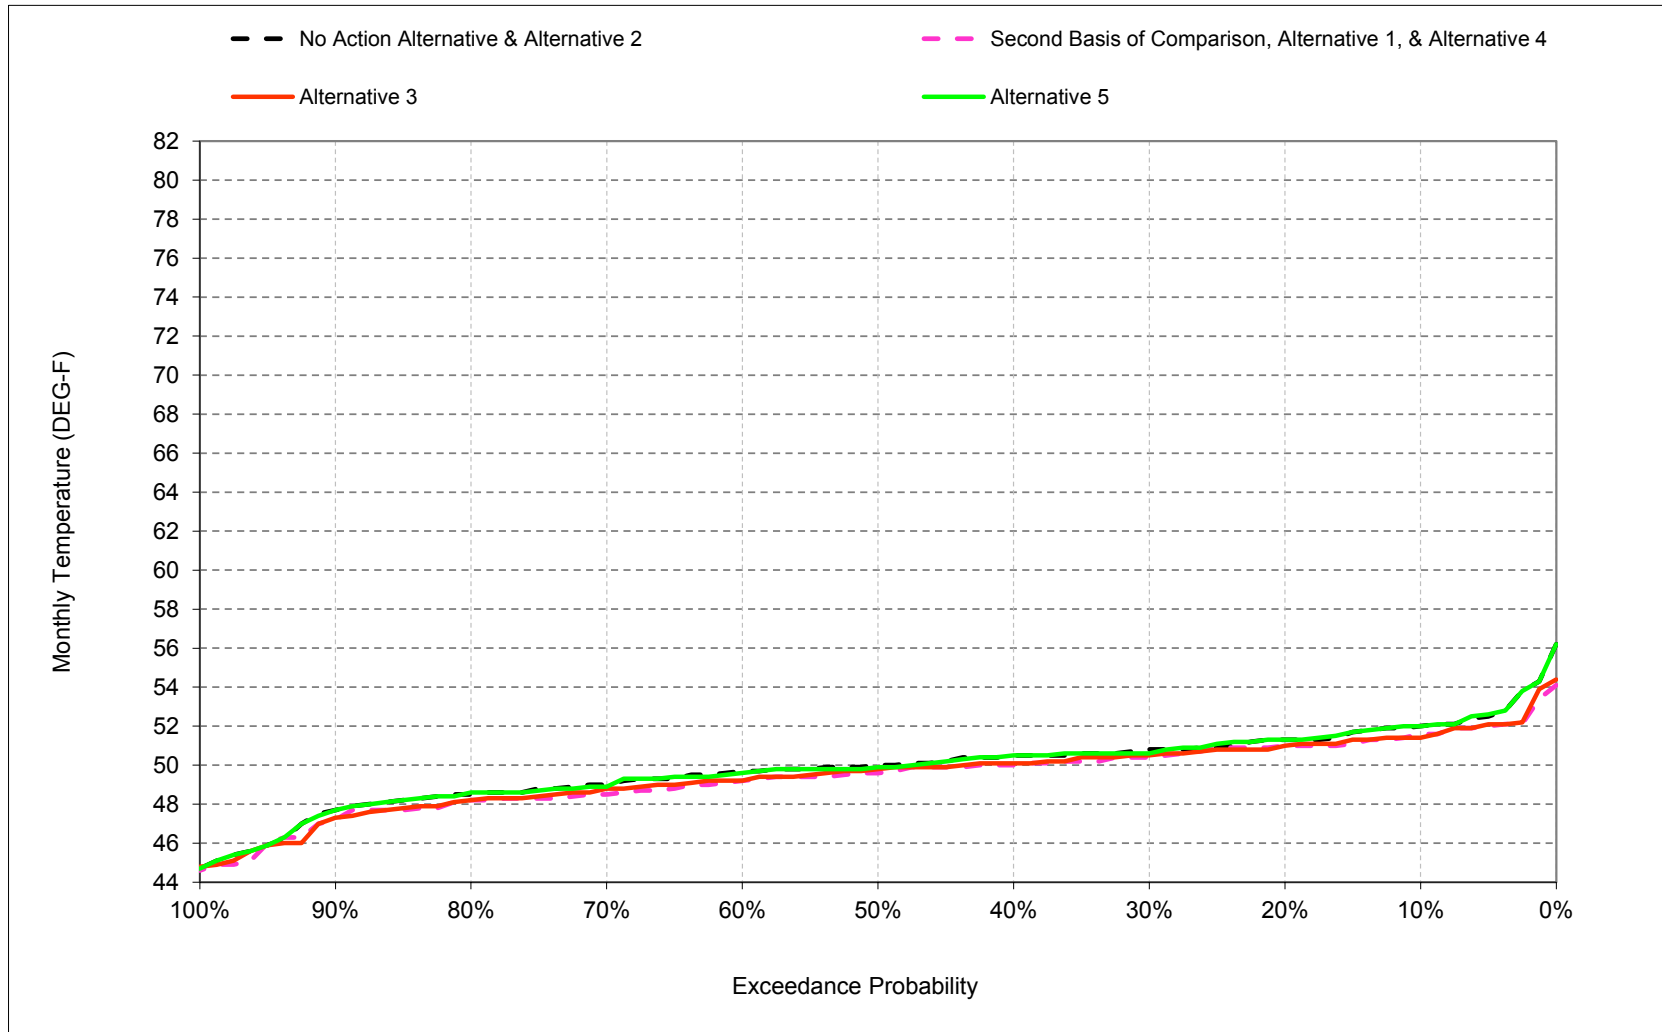


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-21-4. Feather River at Robinson Riffle, January

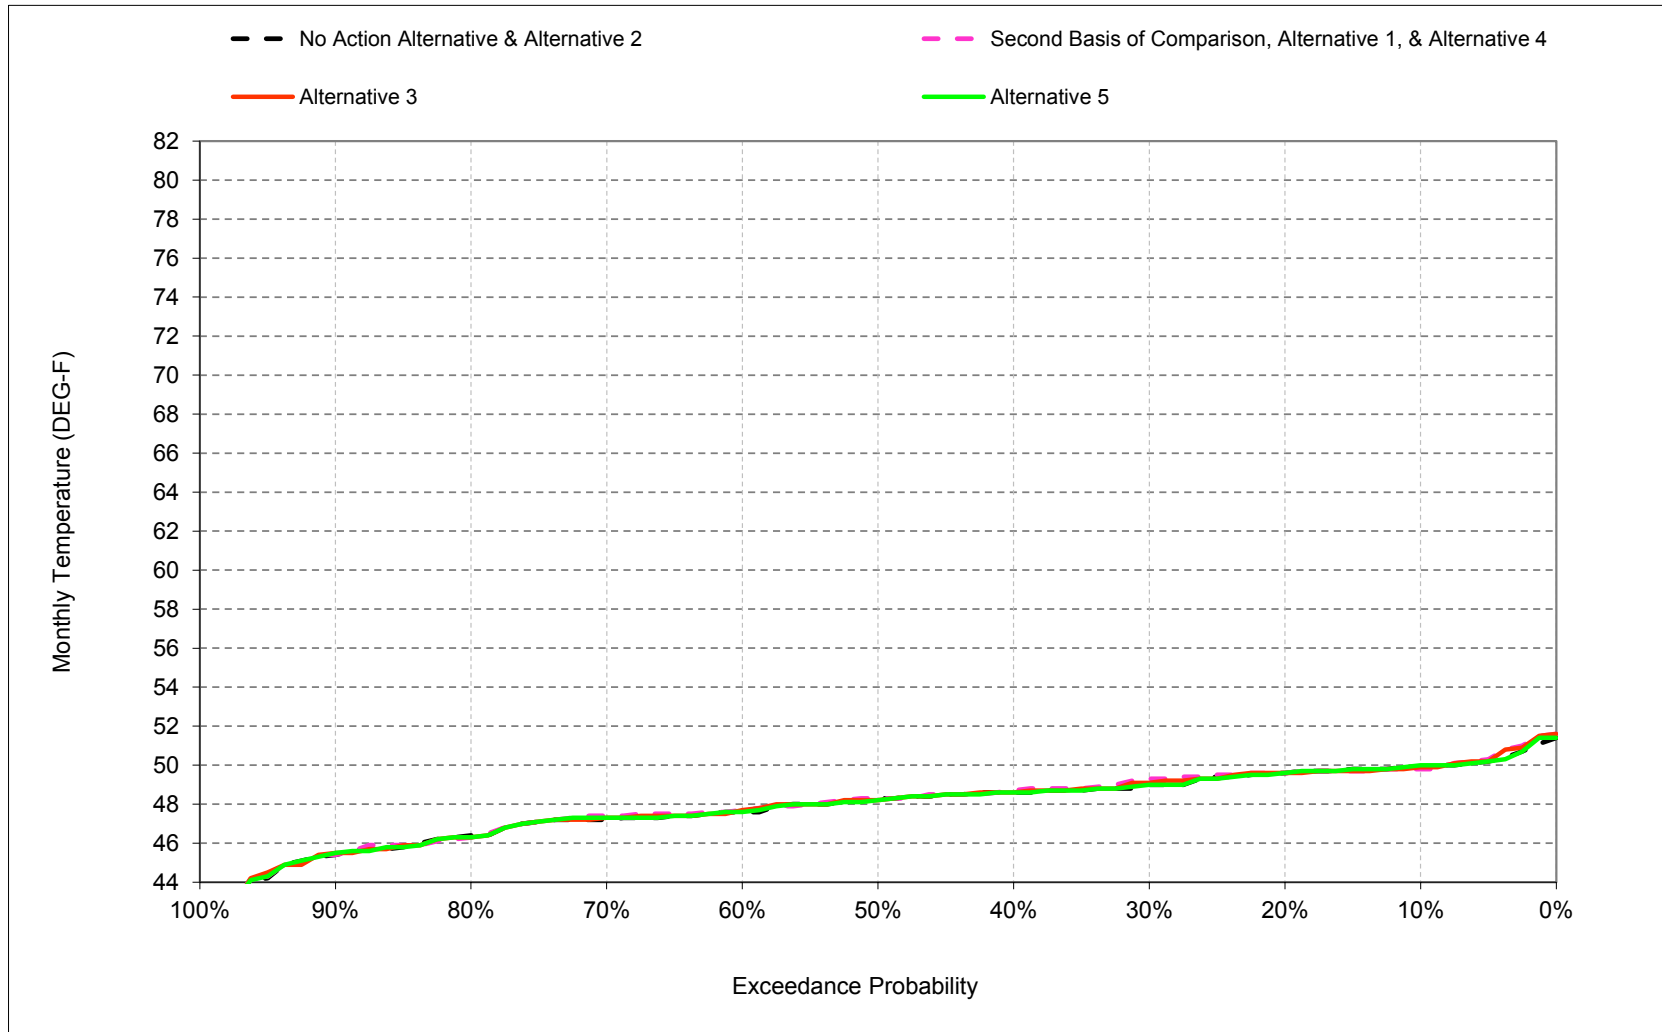


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-21-5. Feather River at Robinson Riffle, February

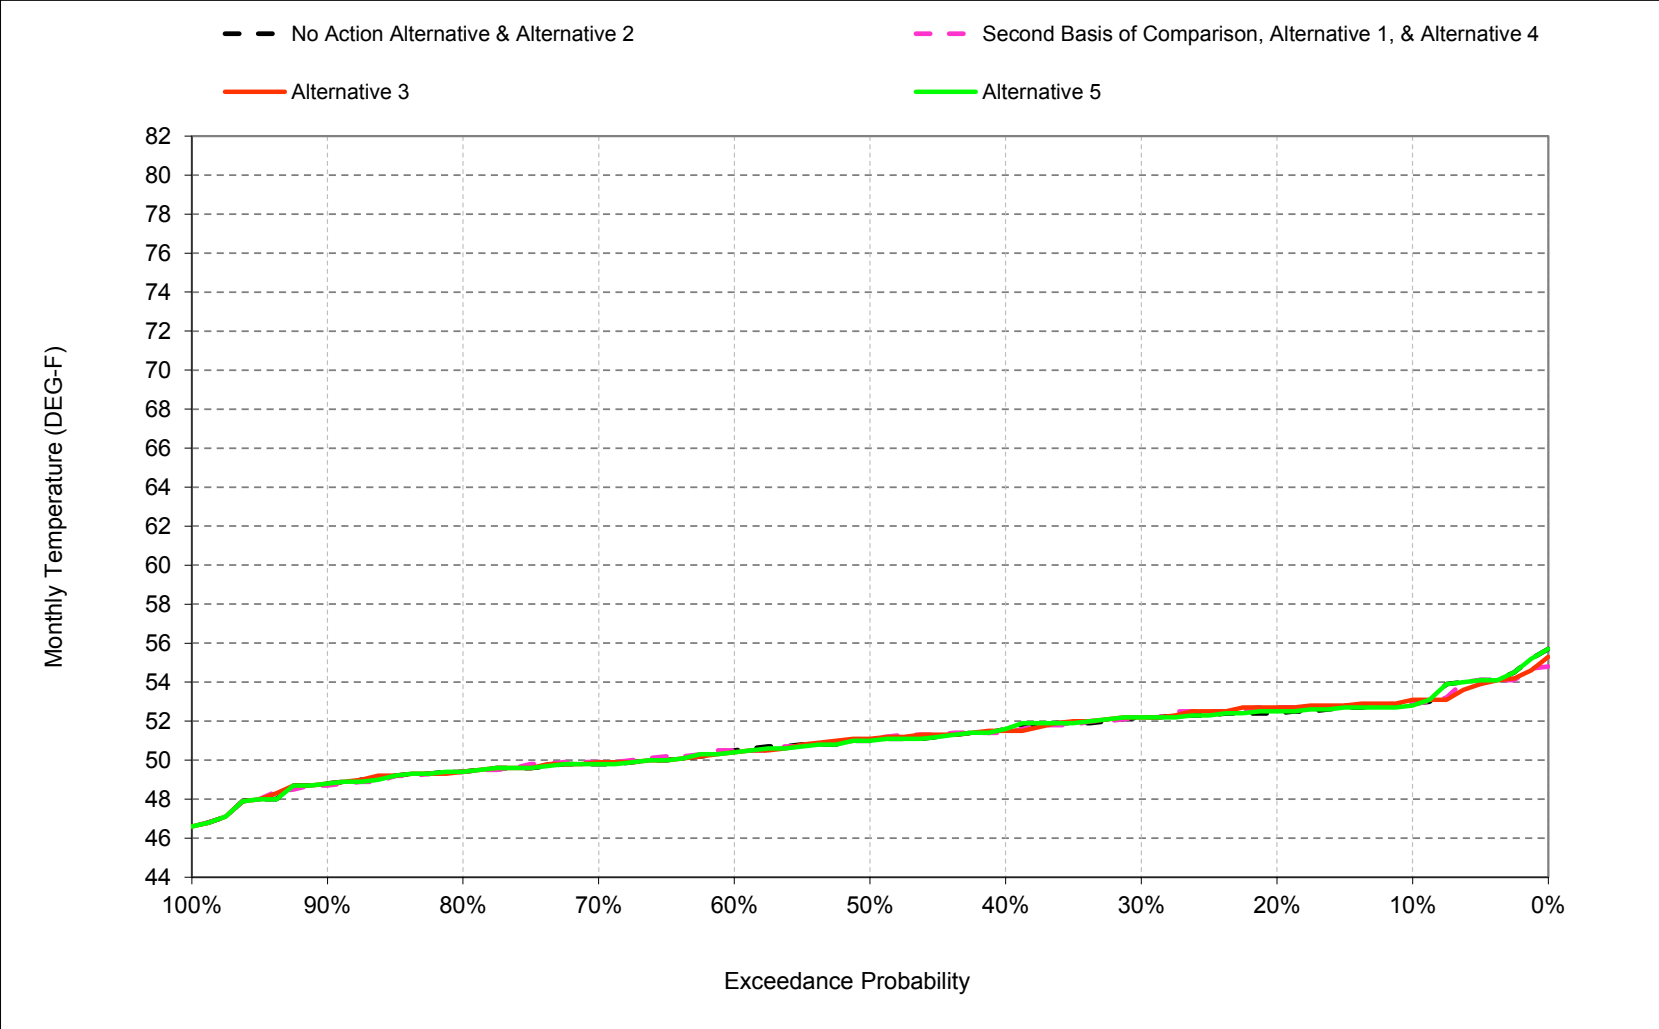


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-21-6. Feather River at Robinson Riffle, March

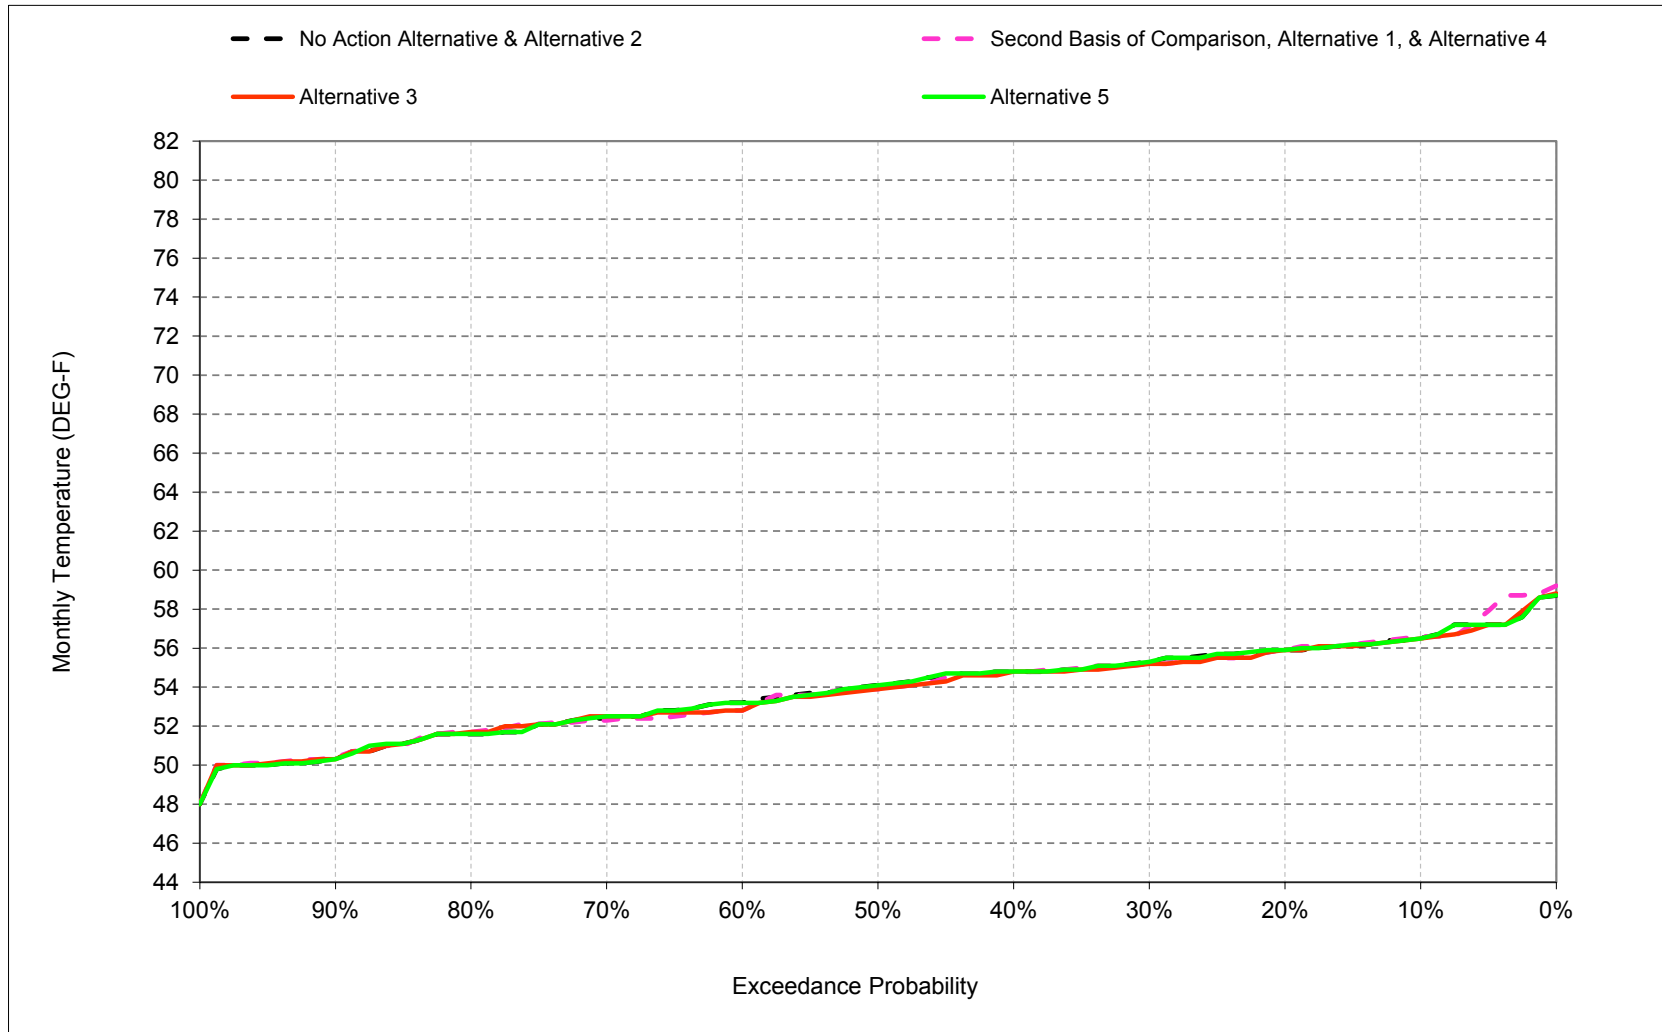


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-21-7. Feather River at Robinson Riffle, April

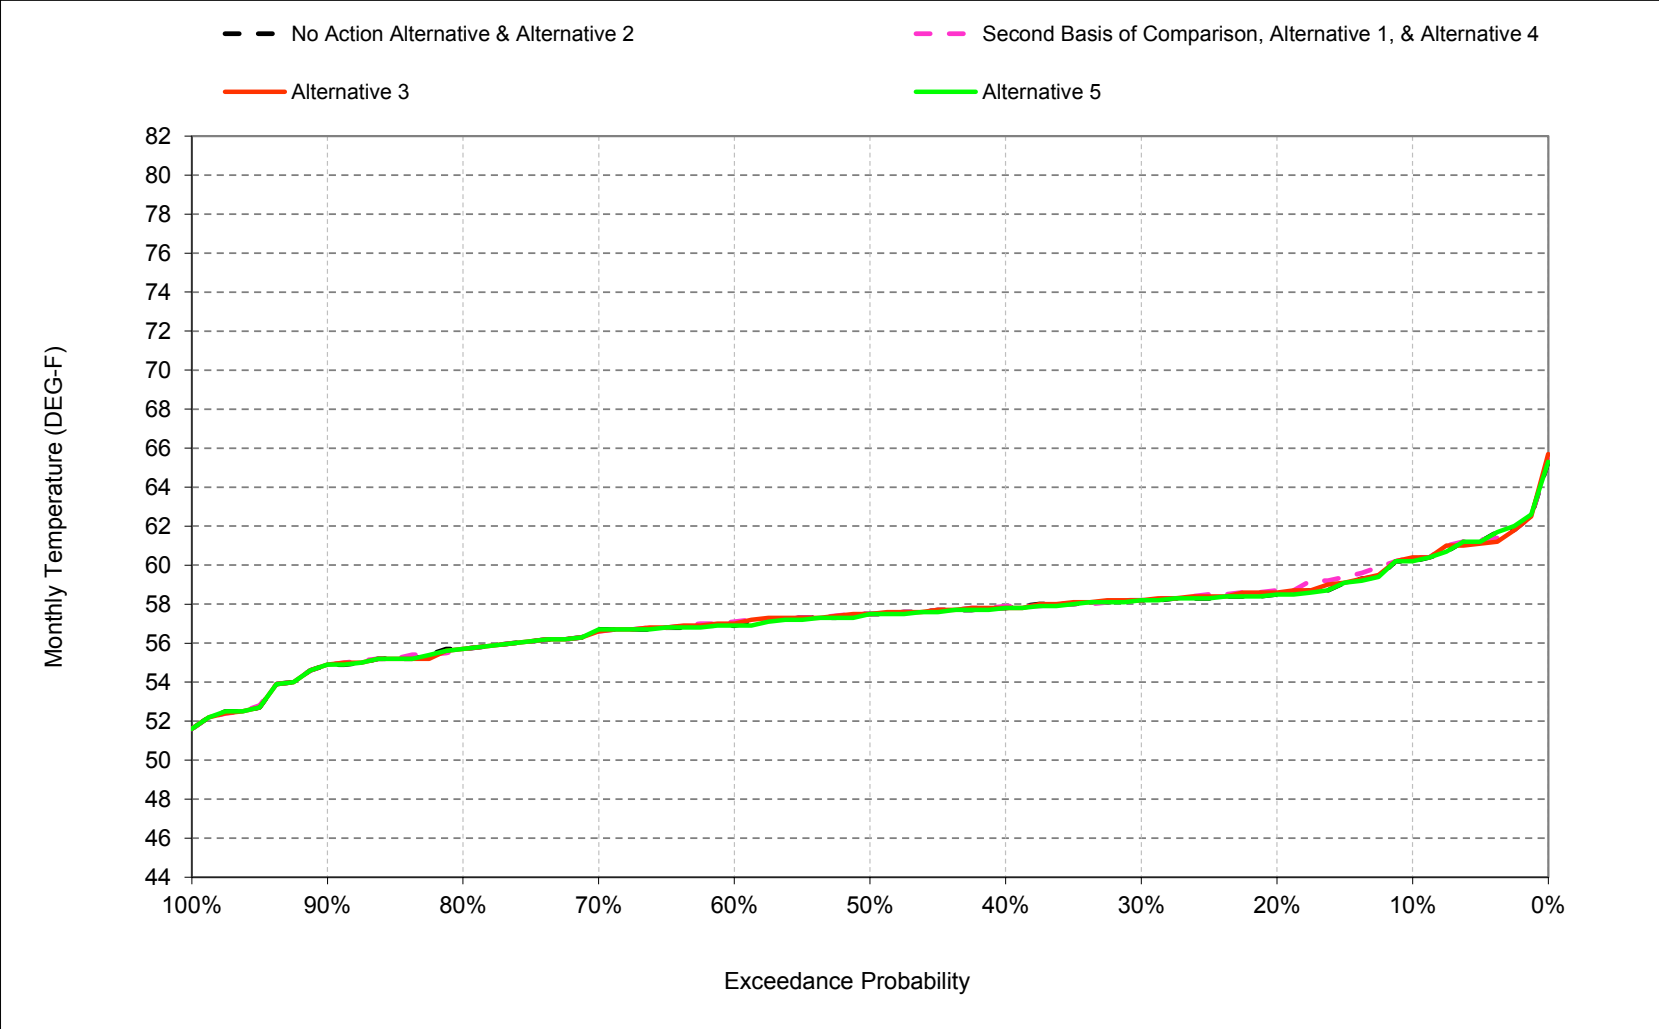


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-21-8. Feather River at Robinson Riffle, May

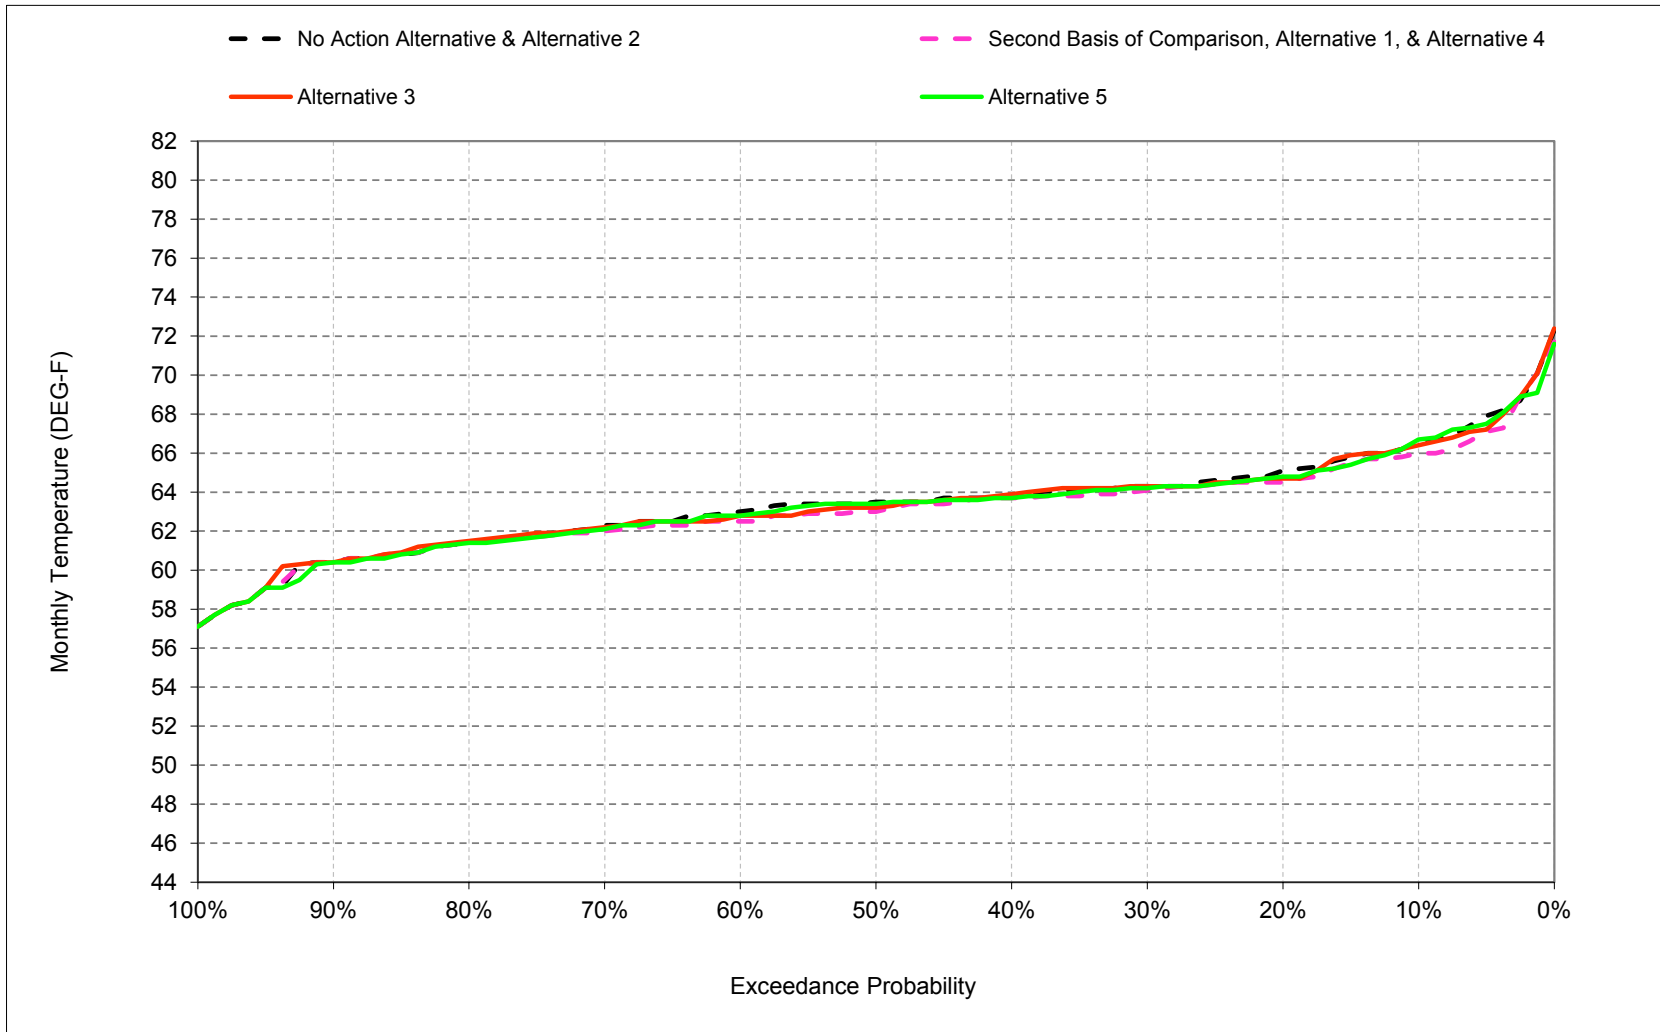


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-21-9. Feather River at Robinson Riffle, June

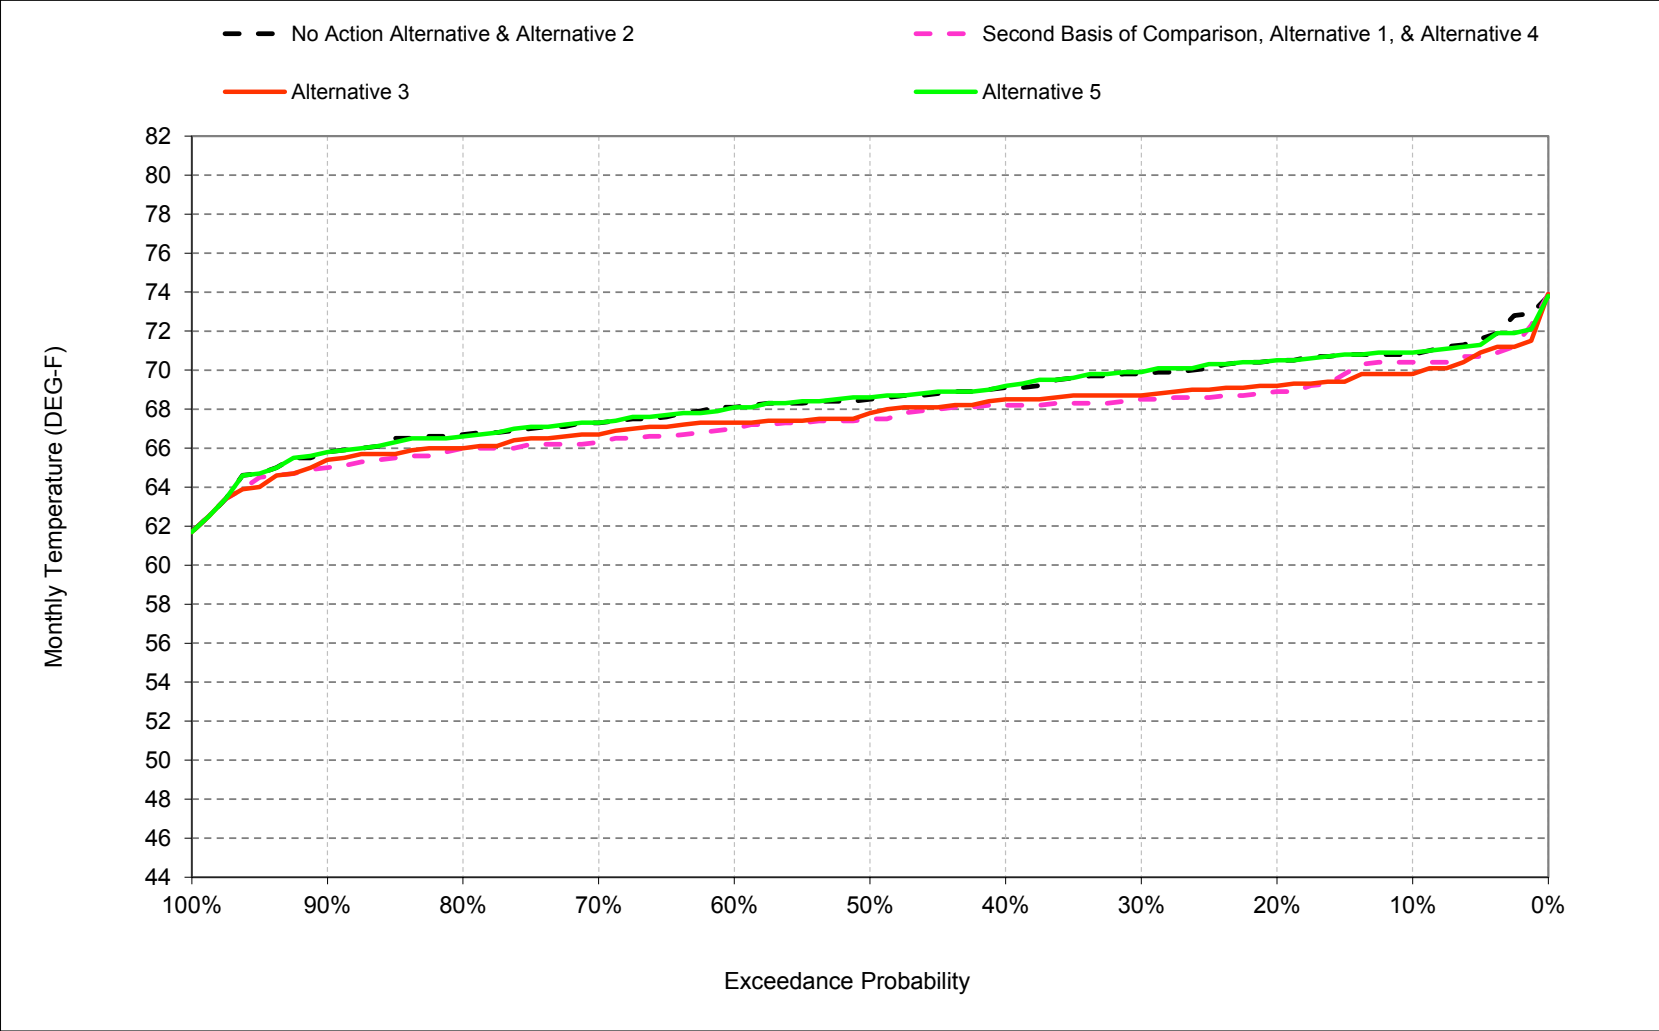


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-21-10. Feather River at Robinson Riffle, July

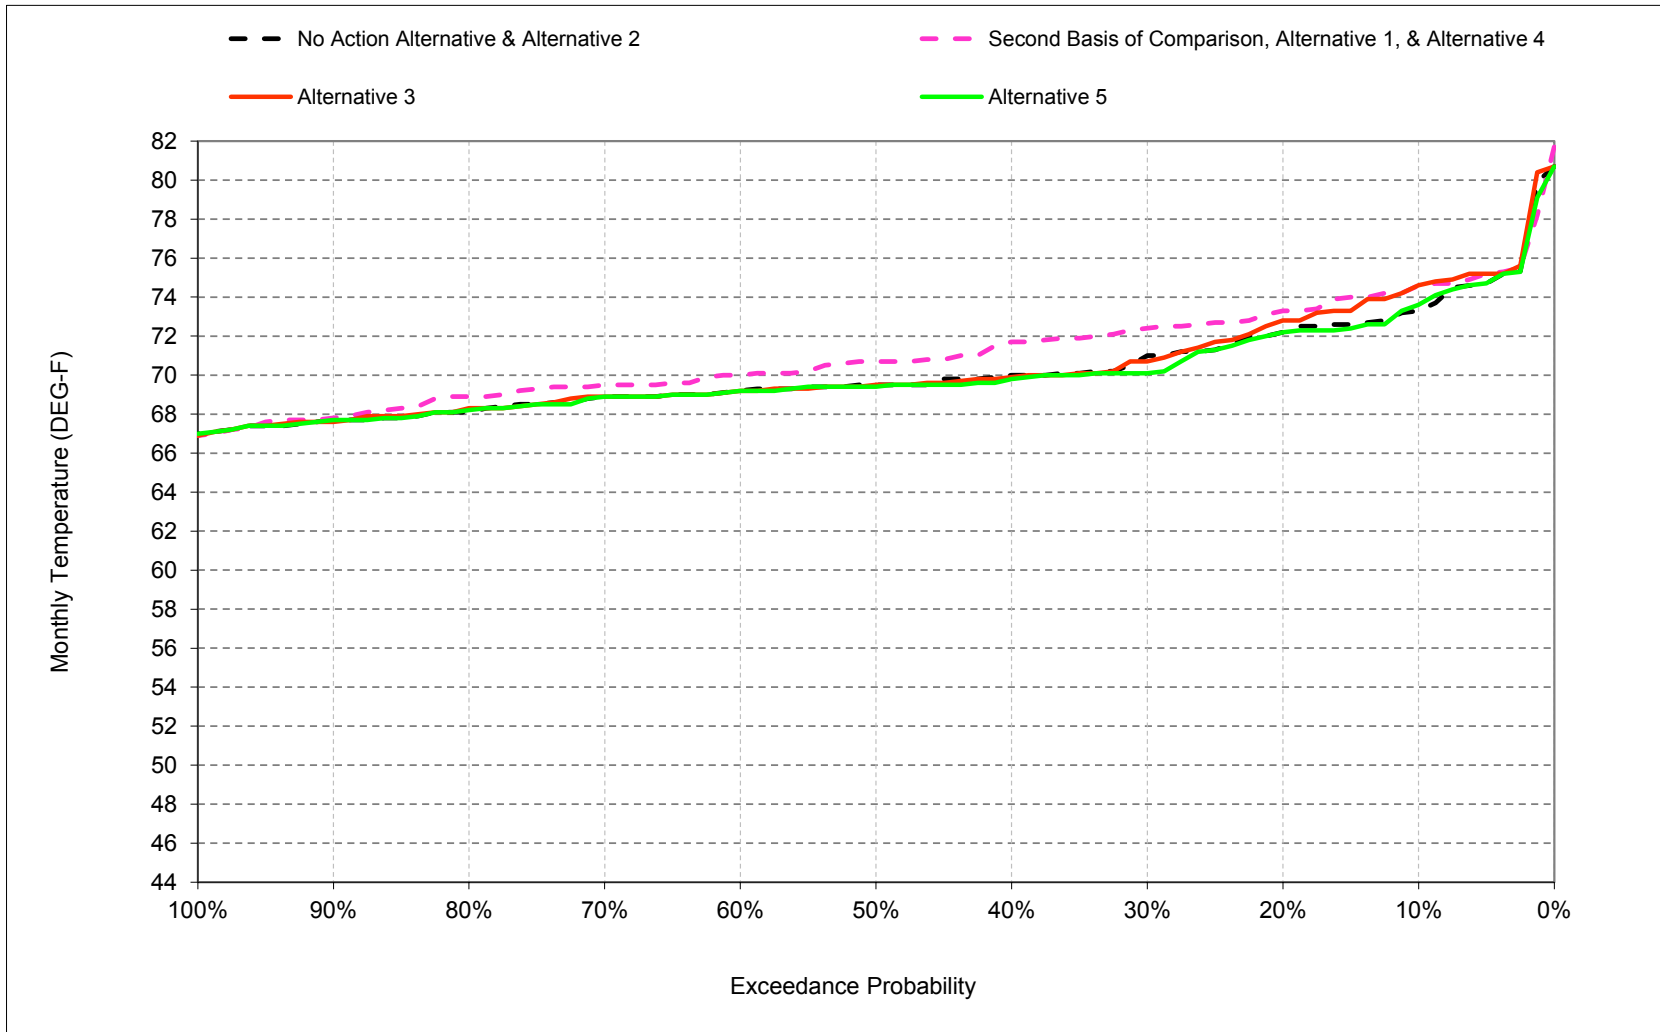


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-21-11. Feather River at Robinson Riffle, August

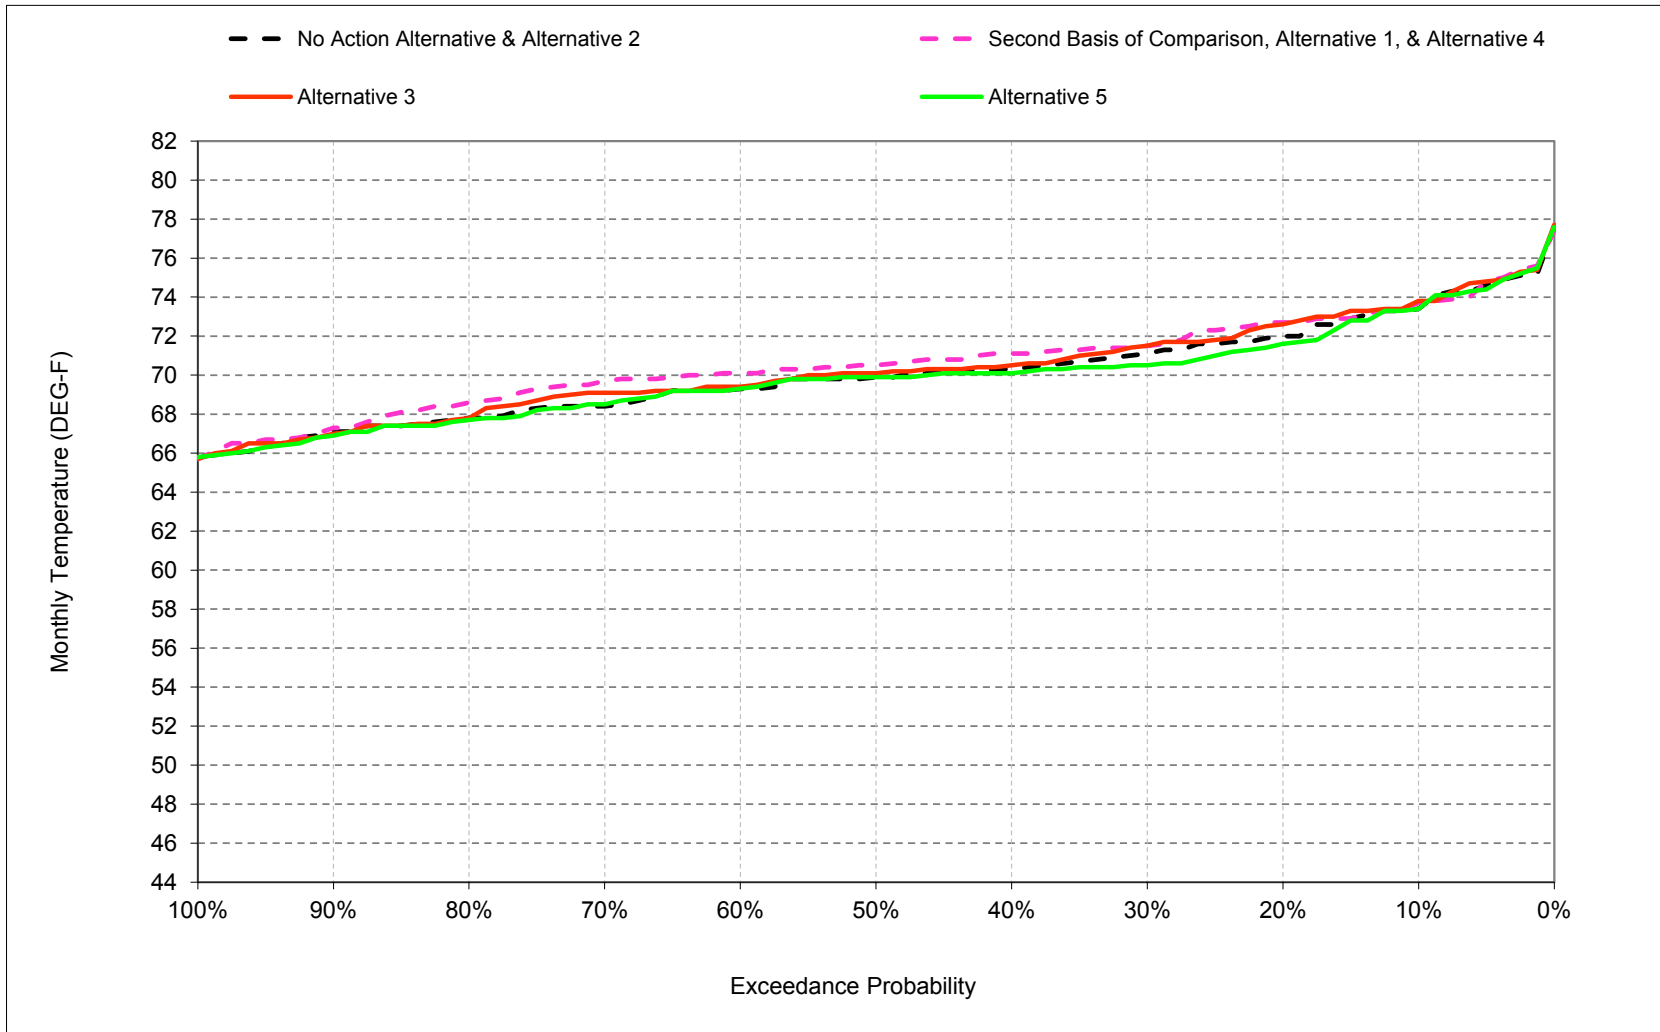

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-21-12. Feather River at Robinson Riffle, September

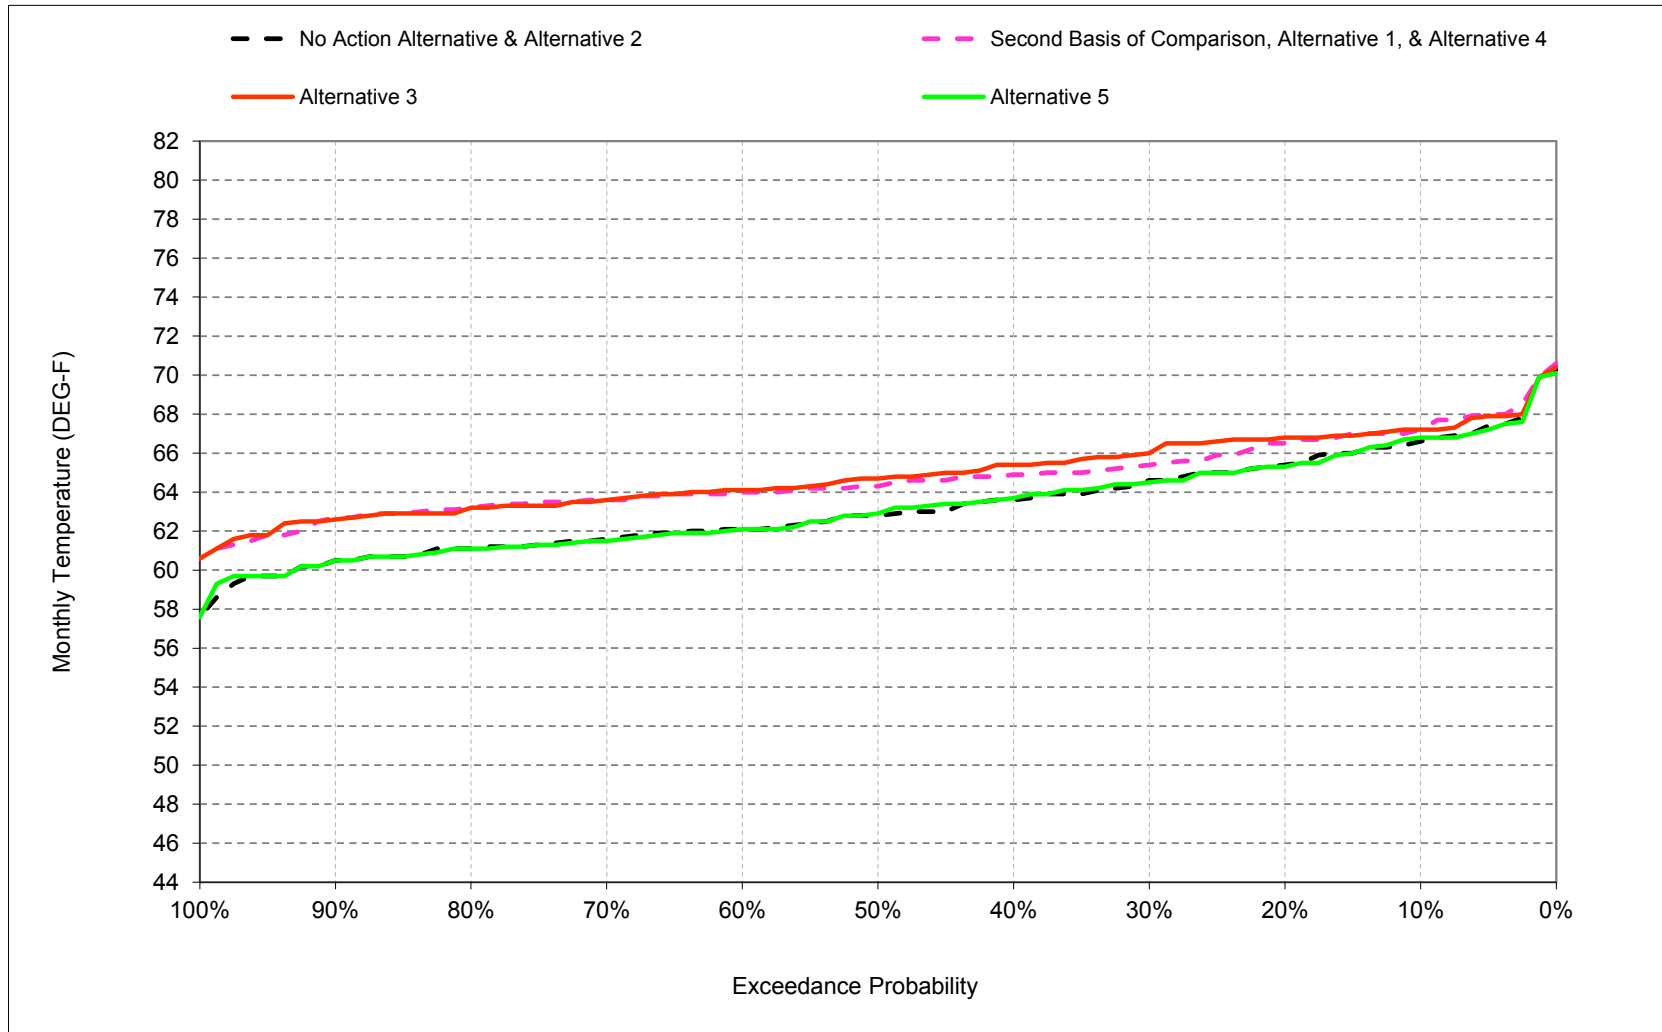

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-21-1. Feather River at Robinson Riffle, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	58	52	50	53	57	60	67	71	73	73	67
20%	60	57	51	50	52	56	59	65	71	72	72	65
30%	60	56	51	49	52	55	58	64	70	71	71	65
40%	59	56	51	49	52	55	58	64	69	70	70	64
50%	59	55	50	48	51	54	58	64	69	70	70	63
60%	59	55	50	48	51	53	57	63	68	69	69	62
70%	58	54	49	47	50	52	57	62	67	69	68	62
80%	57	54	49	46	49	52	56	61	67	68	68	61
90%	57	52	48	45	49	50	55	60	66	68	67	61
Long Term												
Full Simulation Period ^b	59	55	50	48	51	54	57	63	68	70	70	63
Water Year Types ^c												
Wet (32%)	57	53	48	48	50	52	56	62	67	70	69	61
Above Normal (16%)	60	56	50	45	47	49	54	59	63	63	62	57
Below Normal (13%)	59	55	50	48	51	55	59	64	69	69	69	65
Dry (24%)	59	56	50	47	51	55	58	64	69	70	71	64
Critical (15%)	60	56	50	48	52	55	58	64	70	74	73	66

Alternative 1												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	58	52	50	53	57	60	66	70	75	74	67
20%	61	57	51	50	53	56	59	65	69	73	73	67
30%	60	56	50	49	52	55	58	64	69	72	72	65
40%	60	55	50	49	51	55	58	64	68	72	71	65
50%	59	55	50	48	51	54	58	63	68	71	71	64
60%	59	54	49	48	51	53	57	63	67	70	70	64
70%	58	53	49	47	50	52	57	62	66	70	70	64
80%	57	53	48	46	49	52	56	61	66	69	69	63
90%	57	52	47	45	49	50	55	60	65	68	67	63
Long Term												
Full Simulation Period ^b	59	55	49	48	51	54	57	63	68	71	71	65
Water Year Types ^c												
Wet (32%)	56	52	48	48	50	52	56	62	67	70	70	65
Above Normal (16%)	60	55	50	45	47	49	53	59	62	63	63	59
Below Normal (13%)	59	54	49	48	51	55	59	63	67	70	71	65
Dry (24%)	60	55	49	47	51	55	58	64	68	72	71	65
Critical (15%)	60	56	49	48	52	55	58	64	69	75	73	67

Alternative 1 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.5	-0.2	-0.4	-0.1	0.0	0.1	0.2	-0.6	-0.4	1.3	0.3	0.6
0.2	0.7	0.2	-0.3	0.0	0.3	0.0	0.2	-0.6	-1.6	1.1	0.7	1.1
0.3	0.2	-0.2	-0.4	0.3	0.0	-0.1	0.0	-0.2	-1.3	1.4	0.4	0.8
0.4	0.3	-0.2	-0.5	0.1	-0.2	0.0	0.1	-0.1	-0.9	1.7	0.8	1.3
0.5	0.0	-0.4	-0.4	0.0	0.1	-0.2	0.0	-0.5	-1.0	1.2	0.6	1.5
0.6	-0.1	-0.7	-0.5	0.1	0.0	-0.4	0.2	-0.5	-1.1	0.8	0.8	1.9
0.7	-0.3	-1.0	-0.5	0.2	0.1	-0.1	-0.1	-0.3	-1.0	0.6	1.3	2.0
0.8	0.1	-0.8	-0.3	-0.1	0.0	0.1	0.0	0.0	-0.7	0.8	0.8	2.1
0.9	0.2	0.0	-0.5	0.0	-0.1	0.1	0.0	0.0	-0.8	0.1	0.2	2.2
Long Term												
Full Simulation Period ^b	0.1	-0.3	-0.4	0.1	0.0	0.0	0.1	-0.2	-0.9	0.9	0.5	1.5
Water Year Types ^c												
Wet (32%)	-0.2	-0.6	-0.1	0.2	0.1	0.0	0.1	-0.3	0.6	0.9	3.4	
Above Normal (16%)	0.4	-0.1	-0.6	0.1	-0.2	-0.3	-0.1	-0.3	-1.5	0.4	0.8	1.9
Below Normal (13%)	0.1	-0.7	-0.9	0.0	-0.1	0.0	0.0	-0.7	-2.5	0.8	1.5	0.0
Dry (24%)	0.2	-0.3	-0.5	0.0	0.2	0.1	0.1	-0.4	-0.9	1.7	-0.2	0.2
Critical (15%)	0.4	0.6	-0.4	0.1	-0.1	0.3	0.2	-0.1	-0.3	0.4	-0.1	0.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-21-2. Feather River at Robinson Riffle, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	58	52	50	53	57	60	67	71	73	73	67
20%	60	57	51	50	52	56	59	65	71	72	72	65
30%	60	56	51	49	52	55	58	64	70	71	71	65
40%	59	56	51	49	52	55	58	64	69	70	70	64
50%	59	55	50	48	51	54	58	64	69	70	70	63
60%	59	55	50	48	51	53	57	63	68	69	69	62
70%	58	54	49	47	50	52	57	62	67	69	68	62
80%	57	54	49	46	49	52	56	61	67	68	68	61
90%	57	52	48	45	49	50	55	60	66	68	67	61
Long Term												
Full Simulation Period ^b	59	55	50	48	51	54	57	63	68	70	70	63
Water Year Types ^c												
Wet (32%)	57	53	48	48	50	52	56	62	67	70	69	61
Above Normal (16%)	60	56	50	45	47	49	54	59	63	63	62	57
Below Normal (13%)	59	55	50	48	51	55	59	64	69	69	69	65
Dry (24%)	59	56	50	47	51	55	58	64	69	70	71	64
Critical (15%)	60	56	50	48	52	55	58	64	70	74	73	66

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	58	51	50	53	57	60	66	70	75	74	67
20%	61	56	51	50	53	56	59	65	69	73	73	67
30%	60	56	51	49	52	55	58	64	69	71	72	66
40%	59	55	50	49	52	55	58	64	69	70	71	65
50%	59	54	50	48	51	54	58	63	68	70	70	65
60%	59	54	49	48	50	53	57	63	67	69	69	64
70%	58	53	49	47	50	53	57	62	67	69	69	64
80%	57	53	48	46	49	52	56	62	66	68	68	63
90%	57	52	47	46	49	50	55	60	65	68	67	63
Long Term												
Full Simulation Period ^b	59	55	50	48	51	54	57	63	68	70	70	65
Water Year Types ^c												
Wet (32%)	56	52	48	48	50	52	56	62	67	70	70	65
Above Normal (16%)	60	55	50	45	47	49	53	59	62	63	63	59
Below Normal (13%)	59	54	49	48	51	55	58	64	68	69	69	65
Dry (24%)	60	55	49	47	51	55	58	64	68	71	71	65
Critical (15%)	60	56	49	48	52	55	58	64	69	75	73	66

Alternative 3 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.7	-0.3	-0.6	0.0	0.2	0.0	0.2	-0.2	-1.0	1.3	0.4	0.6
0.2	0.4	-0.1	-0.3	0.0	0.3	0.0	0.1	-0.4	-1.3	0.6	0.6	1.4
0.3	-0.1	-0.3	-0.3	0.1	0.0	-0.1	0.0	0.0	-1.1	-0.3	0.4	1.4
0.4	0.1	-0.2	-0.4	0.0	-0.1	0.0	0.0	0.1	-0.6	-0.1	0.2	1.8
0.5	-0.1	-0.9	-0.2	-0.1	0.1	-0.2	0.0	-0.3	-0.7	0.0	0.2	1.9
0.6	-0.1	-0.6	-0.5	0.1	-0.1	-0.4	0.1	-0.2	-0.8	0.0	0.1	2.0
0.7	-0.1	-0.9	-0.2	0.1	0.1	0.1	-0.1	-0.1	-0.6	0.0	0.7	2.0
0.8	0.0	-0.8	-0.3	-0.1	0.0	0.1	0.0	0.1	-0.7	0.2	0.0	2.1
0.9	0.0	0.0	-0.4	0.1	0.0	0.0	0.0	0.0	-0.4	-0.1	-0.1	2.1
Long Term												
Full Simulation Period ^b	0.0	-0.4	-0.4	0.0	0.0	-0.1	0.0	-0.1	-0.8	0.1	0.2	1.7
Water Year Types ^c												
Wet (32%)	-0.2	-0.5	-0.1	0.1	0.1	0.0	0.0	0.0	-0.4	0.1	0.7	3.5
Above Normal (16%)	-0.1	-0.4	-0.5	0.0	0.0	-0.2	-0.1	-0.3	-0.8	0.0	0.3	2.2
Below Normal (13%)	0.1	-0.7	-1.0	0.0	-0.2	0.0	-0.1	-0.2	-1.1	-0.4	-0.5	0.8
Dry (24%)	0.2	-0.4	-0.4	0.0	0.1	0.0	0.1	-0.1	-1.1	0.6	0.1	0.4
Critical (15%)	-0.3	0.0	-0.1	0.0	0.1	-0.2	0.2	0.1	-0.5	0.3	-0.1	-0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-21-3. Feather River at Robinson Riffle, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	58	52	50	53	57	60	67	71	73	73	67
20%	60	57	51	50	52	56	59	65	71	72	72	65
30%	60	56	51	49	52	55	58	64	70	71	71	65
40%	59	56	51	49	52	55	58	64	69	70	70	64
50%	59	55	50	48	51	54	58	64	69	70	70	63
60%	59	55	50	48	51	53	57	63	68	69	69	62
70%	58	54	49	47	50	52	57	62	67	69	68	62
80%	57	54	49	46	49	52	56	61	67	68	68	61
90%	57	52	48	45	49	50	55	60	66	68	67	61
Long Term												
Full Simulation Period ^b	59	55	50	48	51	54	57	63	68	70	70	63
Water Year Types ^c												
Wet (32%)	57	53	48	48	50	52	56	62	67	70	69	61
Above Normal (16%)	60	56	50	45	47	49	54	59	63	63	62	57
Below Normal (13%)	59	55	50	48	51	55	59	64	69	69	69	65
Dry (24%)	59	56	50	47	51	55	58	64	69	70	71	64
Critical (15%)	60	56	50	48	52	55	58	64	70	74	73	66

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	58	52	50	53	57	60	67	71	74	73	67
20%	60	57	51	50	53	56	59	65	71	72	72	65
30%	60	56	51	49	52	55	58	64	70	70	71	65
40%	60	55	51	49	52	55	58	64	69	70	70	64
50%	59	55	50	48	51	54	58	63	69	69	70	63
60%	59	55	50	48	50	53	57	63	68	69	69	62
70%	58	54	49	47	50	53	57	62	67	69	69	62
80%	57	54	49	46	49	52	56	61	67	68	68	61
90%	57	52	48	46	49	50	55	60	66	68	67	61
Long Term												
Full Simulation Period ^b	59	55	50	48	51	54	57	63	68	70	70	63
Water Year Types ^c												
Wet (32%)	57	53	48	48	50	52	56	62	67	70	69	61
Above Normal (16%)	60	55	50	45	47	49	54	59	63	63	62	57
Below Normal (13%)	59	55	50	48	52	55	59	64	69	69	69	65
Dry (24%)	59	55	50	47	51	55	58	64	69	70	71	64
Critical (15%)	60	56	49	48	52	55	58	64	70	74	72	66

Alternative 5 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.7	0.0	0.0	0.1	-0.1	0.0	0.0	0.1	0.1	0.3	0.0	0.2
0.2	0.1	0.0	0.0	0.0	0.1	0.0	0.0	-0.3	0.0	0.0	-0.4	-0.1
0.3	0.0	-0.1	-0.2	0.0	0.0	0.0	0.0	-0.1	0.1	-0.9	-0.6	-0.1
0.4	0.3	-0.1	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	-0.2	-0.2	0.1
0.5	0.0	-0.1	-0.1	-0.1	0.0	0.0	0.0	-0.1	0.1	-0.1	0.0	0.1
0.6	0.0	0.1	-0.1	0.0	-0.1	0.0	0.0	-0.2	0.0	0.0	0.0	0.0
0.7	0.0	0.0	-0.1	0.1	0.0	0.1	0.0	-0.2	0.0	0.0	0.1	-0.1
0.8	0.0	-0.2	0.1	-0.1	0.0	0.0	0.0	0.0	-0.1	0.1	-0.1	0.0
0.9	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.2	0.0
Long Term												
Full Simulation Period ^b	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	-0.1	0.0	-0.1	-0.1	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	0.0
Above Normal (16%)	0.0	-0.1	0.0	0.0	0.0	0.1	0.0	-0.1	0.0	0.0	0.0	0.0
Below Normal (13%)	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	-0.1	0.1	0.0	-0.3	0.1
Dry (24%)	-0.1	-0.2	0.0	0.0	0.0	0.0	0.0	-0.1	-0.1	-0.2	-0.1	0.1
Critical (15%)	-0.2	0.0	0.0	0.0	0.0	0.0	-0.1	-0.4	0.1	-0.1	-0.2	-0.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-21-4. Feather River at Robinson Riffle, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	58	52	50	53	57	60	66	70	75	74	67
20%	61	57	51	50	53	56	59	65	69	73	73	67
30%	60	56	50	49	52	55	58	64	69	72	72	65
40%	60	55	50	49	51	55	58	64	68	72	71	65
50%	59	55	50	48	51	54	58	63	68	71	71	64
60%	59	54	49	48	51	53	57	63	67	70	70	64
70%	58	53	49	47	50	52	57	62	66	70	70	64
80%	57	53	48	46	49	52	56	61	66	69	69	63
90%	57	52	47	45	49	50	55	60	65	68	67	63
Long Term												
Full Simulation Period ^b	59	55	49	48	51	54	57	63	68	71	71	65
Water Year Types ^c												
Wet (32%)	56	52	48	48	50	52	56	62	67	70	70	65
Above Normal (16%)	60	55	50	45	47	49	53	59	62	63	63	59
Below Normal (13%)	59	54	49	48	51	55	59	63	67	70	71	65
Dry (24%)	60	55	49	47	51	55	58	64	68	72	71	65
Critical (15%)	60	56	49	48	52	55	58	64	69	75	73	67

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	58	52	50	53	57	60	67	71	73	73	67
20%	60	57	51	50	52	56	59	65	71	72	72	65
30%	60	56	51	49	52	55	58	64	70	71	71	65
40%	59	56	51	49	52	55	58	64	69	70	70	64
50%	59	55	50	48	51	54	58	64	69	70	70	63
60%	59	55	50	48	51	53	57	63	68	69	69	62
70%	58	54	49	47	50	52	57	62	67	69	68	62
80%	57	54	49	46	49	52	56	61	67	68	68	61
90%	57	52	48	45	49	50	55	60	66	68	67	61
Long Term												
Full Simulation Period ^b	59	55	50	48	51	54	57	63	68	70	70	63
Water Year Types ^c												
Wet (32%)	57	53	48	48	50	52	56	62	67	70	69	61
Above Normal (16%)	60	56	50	45	47	49	54	59	63	63	62	57
Below Normal (13%)	59	55	50	48	51	55	59	64	69	69	69	65
Dry (24%)	59	56	50	47	51	55	58	64	69	70	71	64
Critical (15%)	60	56	50	48	52	55	58	64	70	74	73	66

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.5	0.2	0.4	0.1	0.0	-0.1	-0.2	0.6	0.4	-1.3	-0.3	-0.6
0.2	-0.7	-0.2	0.3	0.0	-0.3	0.0	-0.2	0.6	1.6	-1.1	-0.7	-1.1
0.3	-0.2	0.2	0.4	-0.3	0.0	0.1	0.0	0.2	1.3	-1.4	-0.4	-0.8
0.4	-0.3	0.2	0.5	-0.1	0.2	0.0	-0.1	0.1	0.9	-1.7	-0.8	-1.3
0.5	0.0	0.4	0.4	0.0	-0.1	0.2	0.0	0.5	1.0	-1.2	-0.6	-1.5
0.6	0.1	0.7	0.5	-0.1	0.0	0.4	-0.2	0.5	1.1	-0.8	-0.8	-1.9
0.7	0.3	1.0	0.5	-0.2	-0.1	0.1	0.1	0.3	1.0	-0.6	-1.3	-2.0
0.8	-0.1	0.8	0.3	0.1	0.0	-0.1	0.0	0.0	0.7	-0.8	-0.8	-2.1
0.9	-0.2	0.0	0.5	0.0	0.1	-0.1	0.0	0.0	0.8	-0.1	-0.2	-2.2
Long Term												
Full Simulation Period ^b	-0.1	0.3	0.4	-0.1	0.0	0.0	-0.1	0.2	0.9	-0.9	-0.5	-1.5
Water Year Types ^c												
Wet (32%)	0.2	0.6	0.1	-0.2	-0.1	0.0	0.0	-0.1	0.3	-0.6	-0.9	-3.4
Above Normal (16%)	-0.4	0.1	0.6	-0.1	0.2	0.3	0.1	0.3	1.5	-0.4	-0.8	-1.9
Below Normal (13%)	-0.1	0.7	0.9	0.0	0.1	0.0	0.0	0.7	2.5	-0.8	-1.5	0.0
Dry (24%)	-0.2	0.3	0.5	0.0	-0.2	-0.1	-0.1	0.4	0.9	-1.7	0.2	-0.2
Critical (15%)	-0.4	-0.6	0.4	-0.1	0.1	-0.3	-0.2	0.1	0.3	-0.4	0.1	-0.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-21-5. Feather River at Robinson Riffle, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	58	52	50	53	57	60	66	70	75	74	67
20%	61	57	51	50	53	56	59	65	69	73	73	67
30%	60	56	50	49	52	55	58	64	69	72	72	65
40%	60	55	50	49	51	55	58	64	68	72	71	65
50%	59	55	50	48	51	54	58	63	68	71	71	64
60%	59	54	49	48	51	53	57	63	67	70	70	64
70%	58	53	49	47	50	52	57	62	66	70	70	64
80%	57	53	48	46	49	52	56	61	66	69	69	63
90%	57	52	47	45	49	50	55	60	65	68	67	63
Long Term												
Full Simulation Period ^b	59	55	49	48	51	54	57	63	68	71	71	65
Water Year Types ^c												
Wet (32%)	56	52	48	48	50	52	56	62	67	70	70	65
Above Normal (16%)	60	55	50	45	47	49	53	59	62	63	63	59
Below Normal (13%)	59	54	49	48	51	55	59	63	67	70	71	65
Dry (24%)	60	55	49	47	51	55	58	64	68	72	71	65
Critical (15%)	60	56	49	48	52	55	58	64	69	75	73	67

Alternative 3

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	58	51	50	53	57	60	66	70	75	74	67
20%	61	56	51	50	53	56	59	65	69	73	73	67
30%	60	56	51	49	52	55	58	64	69	71	72	66
40%	59	55	50	49	52	55	58	64	69	70	71	65
50%	59	54	50	48	51	54	58	63	68	70	70	65
60%	59	54	49	48	50	53	57	63	67	69	69	64
70%	58	53	49	47	50	53	57	62	67	69	69	64
80%	57	53	48	46	49	52	56	62	66	68	68	63
90%	57	52	47	46	49	50	55	60	65	68	67	63
Long Term												
Full Simulation Period ^b	59	55	50	48	51	54	57	63	68	70	70	65
Water Year Types ^c												
Wet (32%)	56	52	48	48	50	52	56	62	67	70	70	65
Above Normal (16%)	60	55	50	45	47	49	53	59	62	63	63	59
Below Normal (13%)	59	54	49	48	51	55	58	64	68	69	69	65
Dry (24%)	60	55	49	47	51	55	58	64	68	71	71	65
Critical (15%)	60	56	49	48	52	55	58	64	69	75	73	66

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.2	-0.1	-0.2	0.1	0.2	-0.1	0.0	0.4	-0.6	0.0	0.1	0.0
0.2	-0.3	-0.3	0.0	0.0	0.0	0.0	-0.1	0.2	0.3	-0.5	-0.1	0.3
0.3	-0.3	-0.1	0.1	-0.2	0.0	0.0	0.0	0.2	0.2	-1.7	0.0	0.6
0.4	-0.2	0.0	0.1	-0.1	0.1	0.0	-0.1	0.2	0.3	-1.8	-0.6	0.5
0.5	-0.1	-0.5	0.2	-0.1	0.0	0.0	0.0	0.2	0.3	-1.2	-0.4	0.4
0.6	0.0	0.1	0.0	0.0	-0.1	0.0	-0.1	0.3	0.3	-0.8	-0.7	0.1
0.7	0.2	0.1	0.3	-0.1	0.0	0.2	0.0	0.2	0.4	-0.6	-0.6	0.0
0.8	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	-0.6	-0.8	0.0
0.9	-0.2	0.0	0.1	0.1	0.1	-0.1	0.0	0.0	0.4	-0.2	-0.3	-0.1
Long Term												
Full Simulation Period ^b	-0.1	-0.1	0.1	0.0	0.0	-0.1	0.0	0.2	0.2	-0.7	-0.3	0.2
Water Year Types ^c												
Wet (32%)	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	-0.2	-0.5	-0.2	0.2
Above Normal (16%)	-0.5	-0.2	0.2	-0.1	0.2	0.1	0.0	0.1	0.6	-0.5	-0.5	0.3
Below Normal (13%)	0.0	0.0	-0.1	0.0	-0.1	0.0	0.0	0.5	1.4	-1.2	-2.0	0.8
Dry (24%)	0.1	-0.2	0.1	0.0	-0.1	-0.1	-0.1	0.3	-0.2	-1.2	0.3	0.2
Critical (15%)	-0.8	-0.5	0.3	-0.1	0.2	-0.5	0.0	0.3	-0.2	-0.1	0.0	-0.5

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-21-6. Feather River at Robinson Riffle, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	58	52	50	53	57	60	66	70	75	74	67
20%	61	57	51	50	53	56	59	65	69	73	73	67
30%	60	56	50	49	52	55	58	64	69	72	72	65
40%	60	55	50	49	51	55	58	64	68	72	71	65
50%	59	55	50	48	51	54	58	63	68	71	71	64
60%	59	54	49	48	51	53	57	63	67	70	70	64
70%	58	53	49	47	50	52	57	62	66	70	70	64
80%	57	53	48	46	49	52	56	61	66	69	69	63
90%	57	52	47	45	49	50	55	60	65	68	67	63
Long Term												
Full Simulation Period ^b	59	55	49	48	51	54	57	63	68	71	71	65
Water Year Types ^c												
Wet (32%)	56	52	48	48	50	52	56	62	67	70	70	65
Above Normal (16%)	60	55	50	45	47	49	53	59	62	63	63	59
Below Normal (13%)	59	54	49	48	51	55	59	63	67	70	71	65
Dry (24%)	60	55	49	47	51	55	58	64	68	72	71	65
Critical (15%)	60	56	49	48	52	55	58	64	69	75	73	67

Alternative 5

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	58	52	50	53	57	60	67	71	74	73	67
20%	60	57	51	50	53	56	59	65	71	72	72	65
30%	60	56	51	49	52	55	58	64	70	70	71	65
40%	60	55	51	49	52	55	58	64	69	70	70	64
50%	59	55	50	48	51	54	58	63	69	69	70	63
60%	59	55	50	48	50	53	57	63	68	69	69	62
70%	58	54	49	47	50	53	57	62	67	69	69	62
80%	57	54	49	46	49	52	56	61	67	68	68	61
90%	57	52	48	46	49	50	55	60	66	68	67	61
Long Term												
Full Simulation Period ^b	59	55	50	48	51	54	57	63	68	70	70	63
Water Year Types ^c												
Wet (32%)	57	53	48	48	50	52	56	62	67	70	69	61
Above Normal (16%)	60	55	50	45	47	49	54	59	63	63	62	57
Below Normal (13%)	59	55	50	48	52	55	59	64	69	69	69	65
Dry (24%)	59	55	50	47	51	55	58	64	69	70	71	64
Critical (15%)	60	56	49	48	52	55	58	64	70	74	72	66

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.2	0.2	0.4	0.2	-0.1	-0.1	-0.2	0.7	0.5	-1.0	-0.3	-0.4
0.2	-0.6	-0.2	0.3	0.0	-0.2	0.0	-0.2	0.3	1.6	-1.1	-1.1	-1.2
0.3	-0.2	0.1	0.2	-0.3	0.0	0.1	0.0	0.1	1.4	-2.3	-1.0	-0.9
0.4	0.0	0.1	0.5	-0.1	0.2	0.0	-0.1	0.0	1.0	-1.9	-1.0	-1.2
0.5	0.0	0.3	0.3	-0.1	-0.1	0.2	0.0	0.4	1.1	-1.3	-0.6	-1.4
0.6	0.1	0.8	0.4	-0.1	-0.1	0.4	-0.2	0.3	1.1	-0.8	-0.8	-1.9
0.7	0.3	1.0	0.4	-0.1	-0.1	0.2	0.1	0.1	1.0	-0.6	-1.2	-2.1
0.8	-0.1	0.6	0.4	0.0	0.0	-0.1	0.0	0.0	0.6	-0.7	-0.9	-2.1
0.9	-0.2	0.0	0.5	0.1	0.1	-0.1	0.0	0.0	0.8	-0.1	-0.4	-2.2
Long Term												
Full Simulation Period ^b	-0.2	0.2	0.4	-0.1	0.0	0.0	-0.1	0.1	0.9	-0.9	-0.7	-1.5
Water Year Types ^c												
Wet (32%)	0.2	0.6	0.1	-0.2	-0.1	0.0	0.0	-0.1	0.3	-0.6	-1.0	-3.3
Above Normal (16%)	-0.4	0.0	0.6	-0.1	0.2	0.3	0.1	0.2	1.5	-0.4	-0.8	-1.9
Below Normal (13%)	-0.2	0.6	0.9	0.0	0.2	0.0	0.0	0.6	2.6	-0.9	-1.9	0.1
Dry (24%)	-0.3	0.1	0.4	0.0	-0.2	-0.1	-0.1	0.3	0.8	-1.9	0.1	-0.1
Critical (15%)	-0.6	-0.6	0.4	0.0	0.1	-0.3	-0.4	-0.2	0.4	-0.5	0.0	-0.6

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


B.22. Feather River at Gridley Bridge

Figure B-22-1. Feather River at Gridley Bridge, October

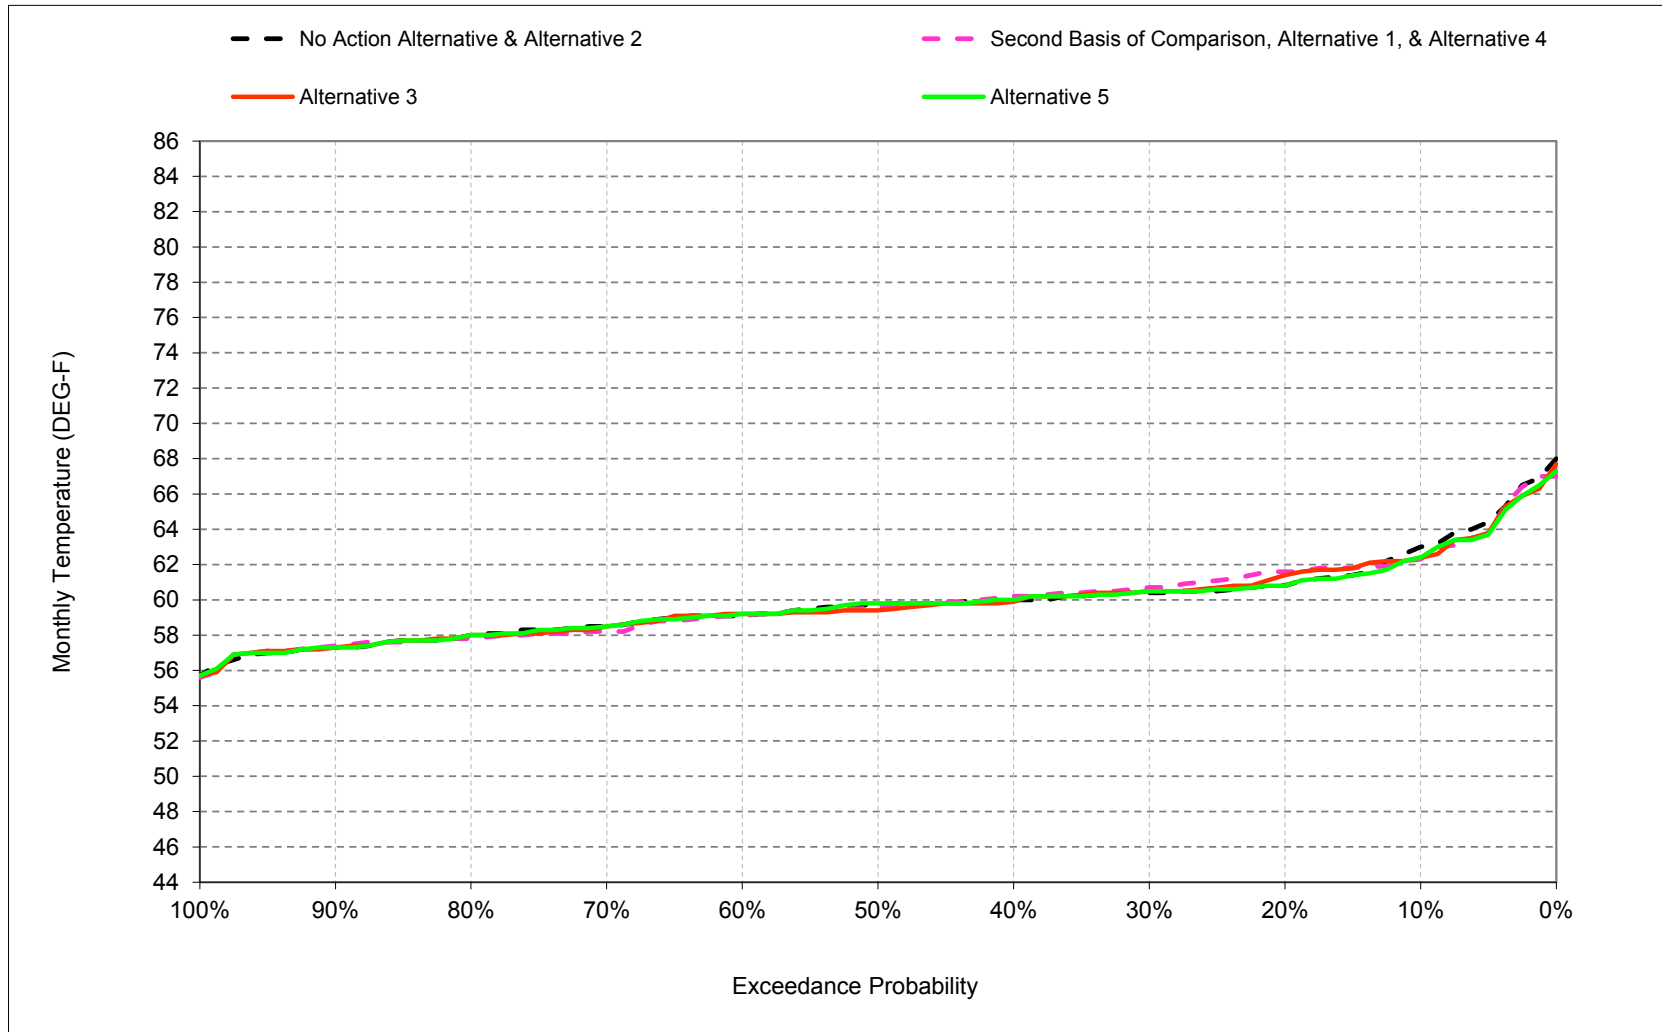


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-22-2. Feather River at Gridley Bridge, November

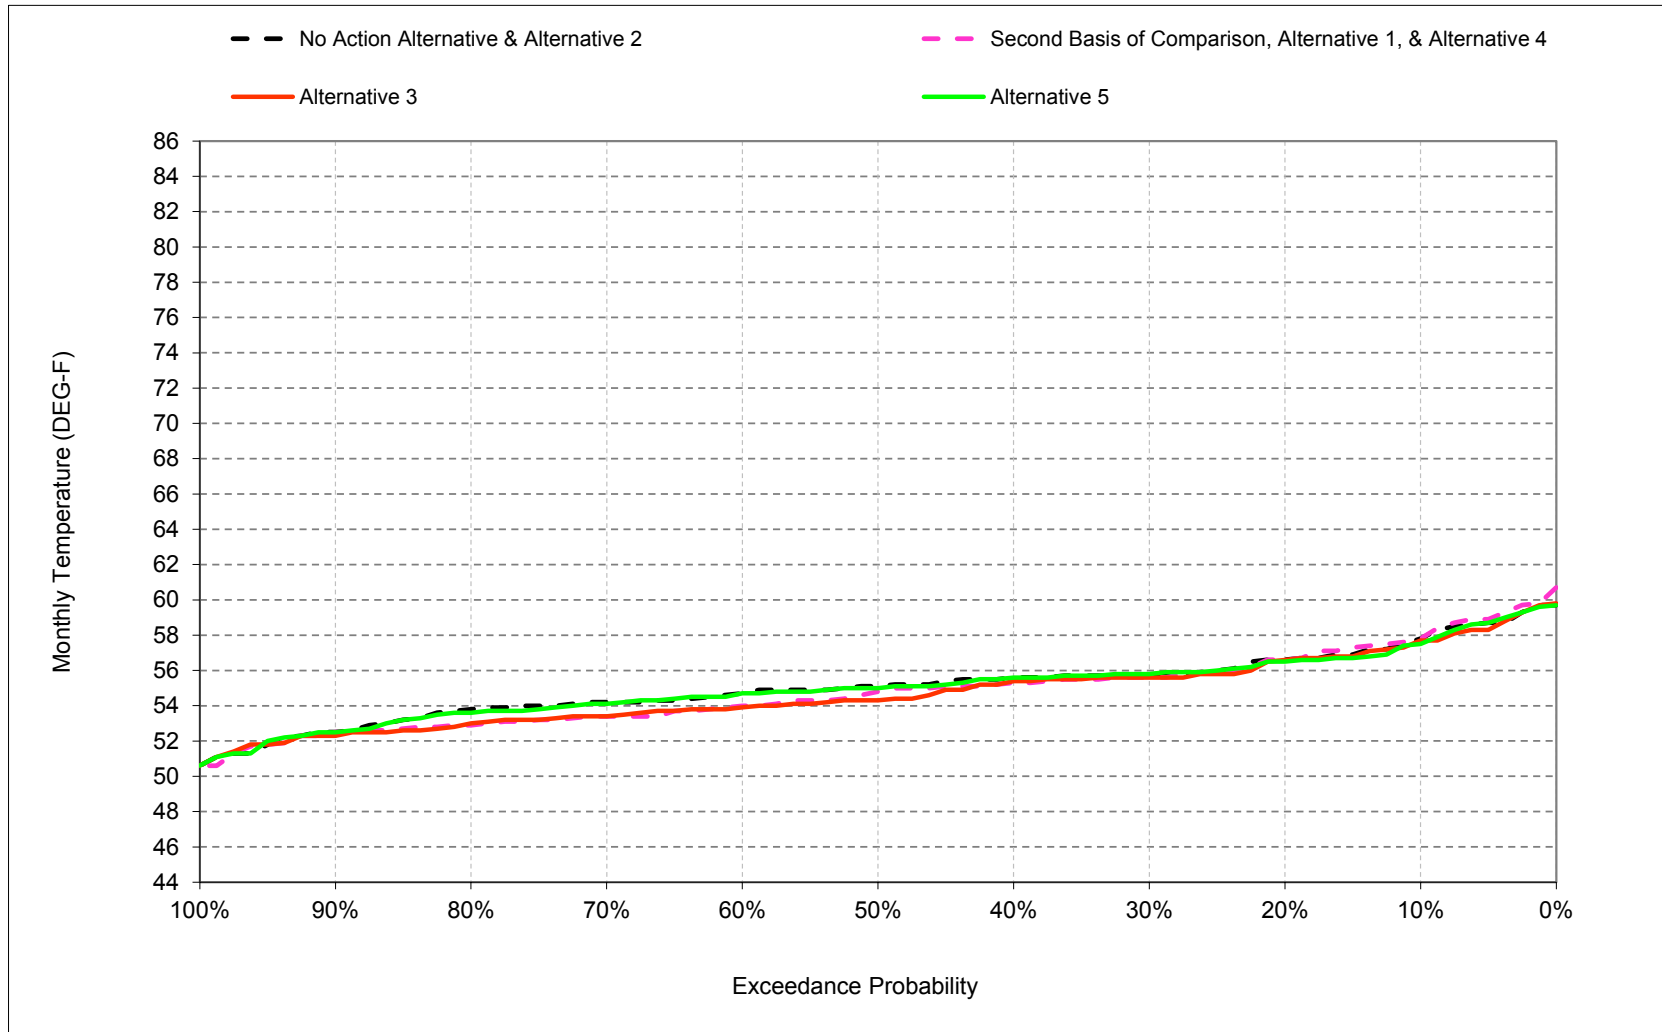


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-22-3. Feather River at Gridley Bridge, December

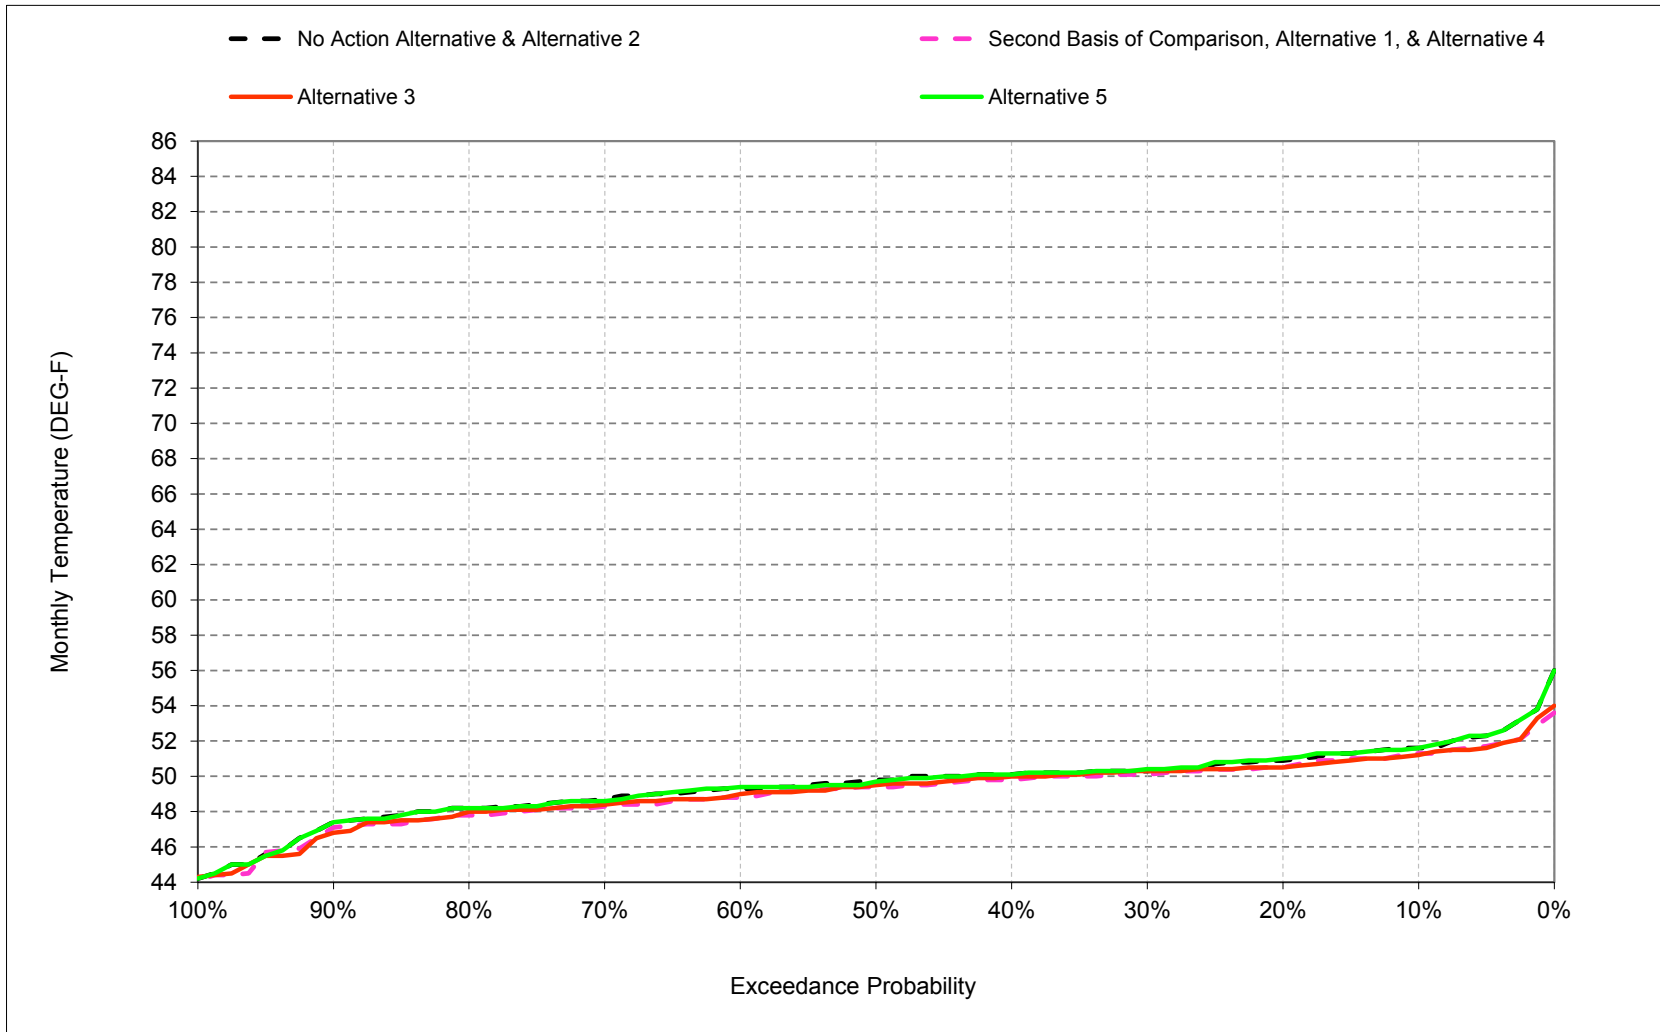


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-22-4. Feather River at Gridley Bridge, January

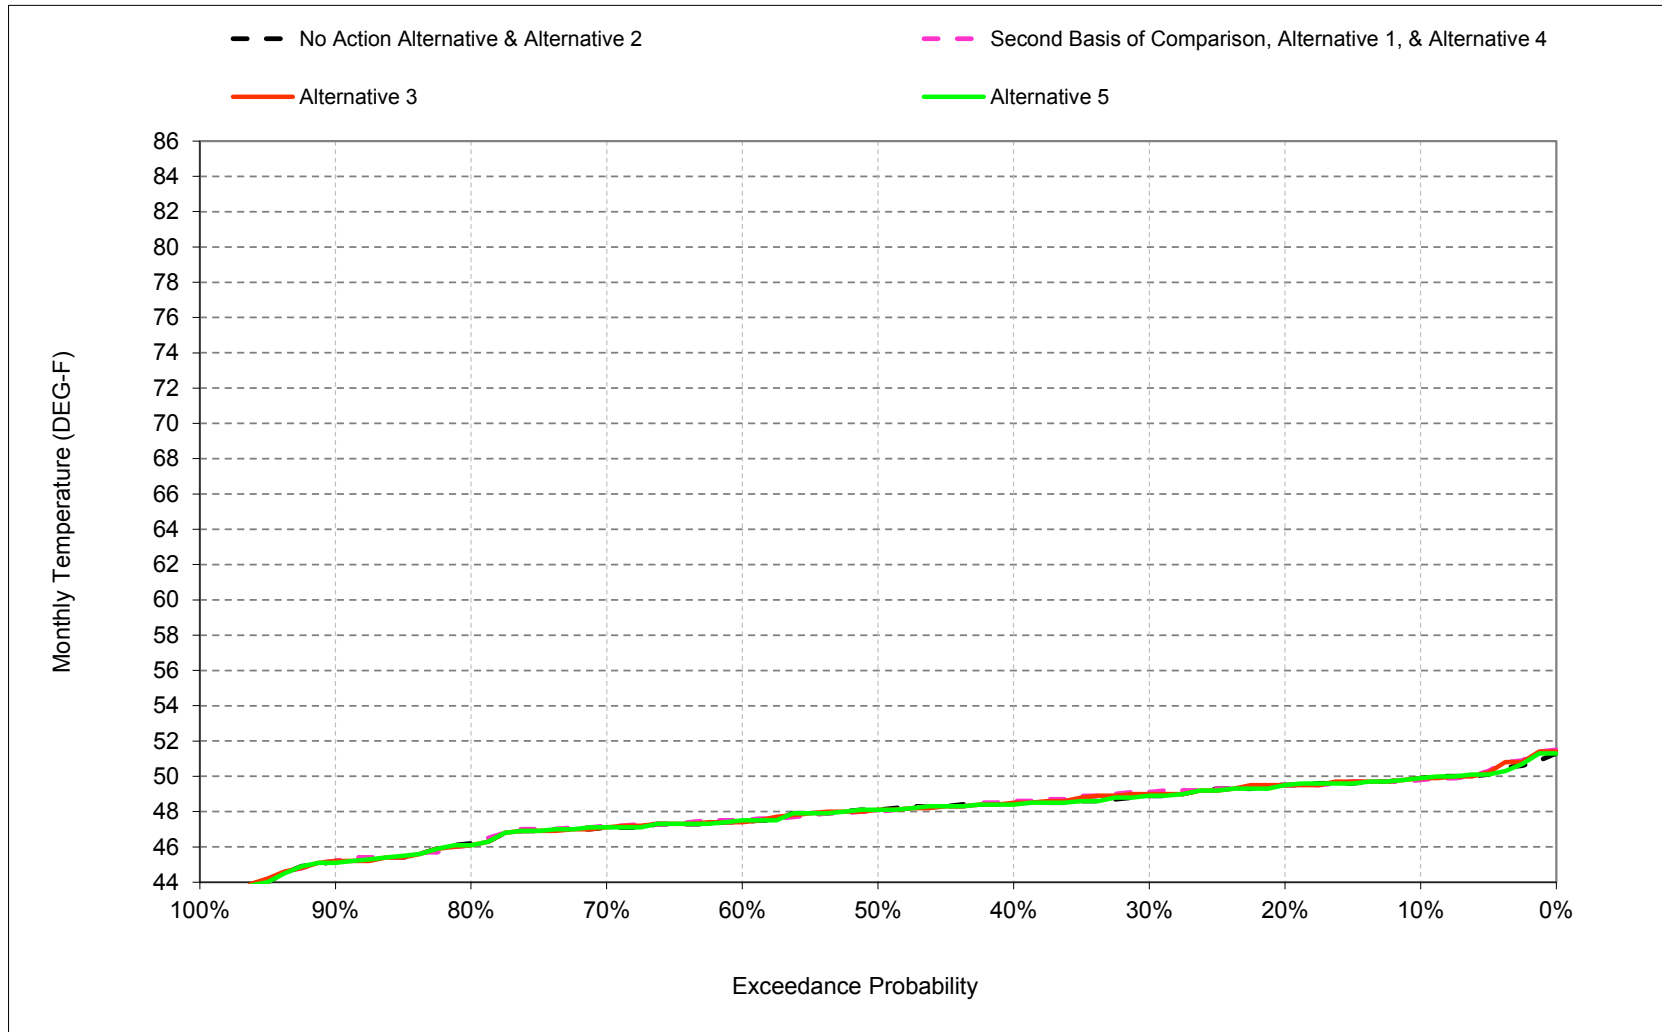


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-22-5. Feather River at Gridley Bridge, February

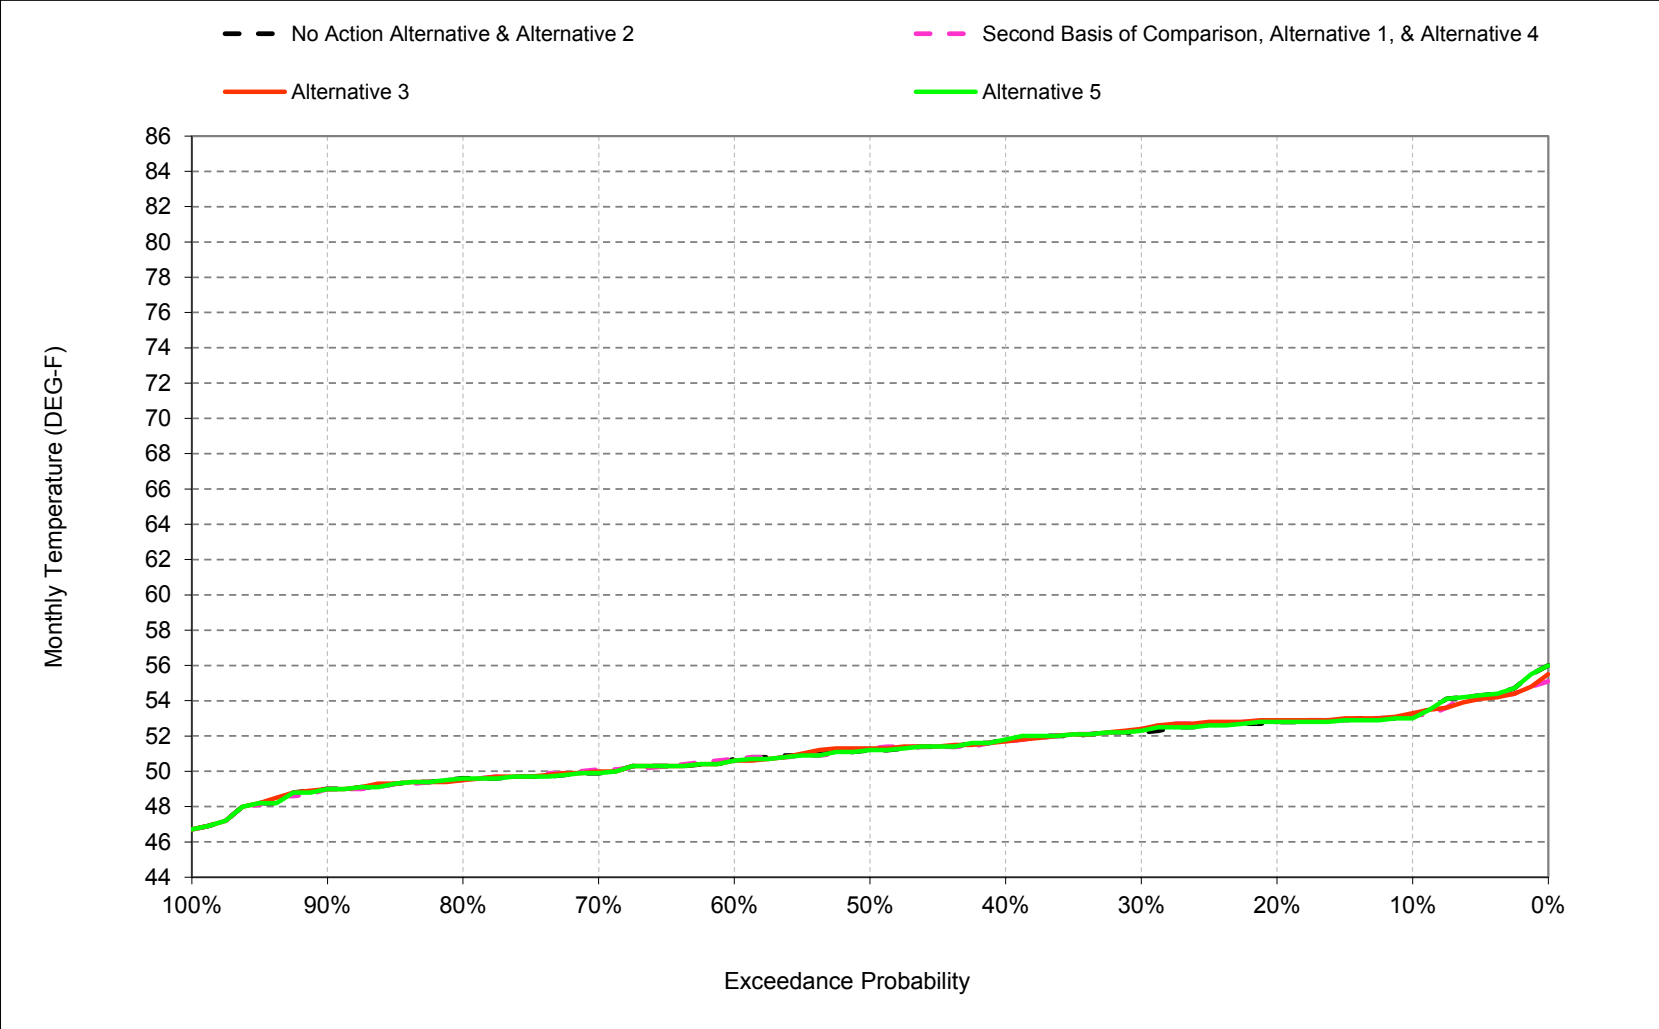


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-22-6. Feather River at Gridley Bridge, March

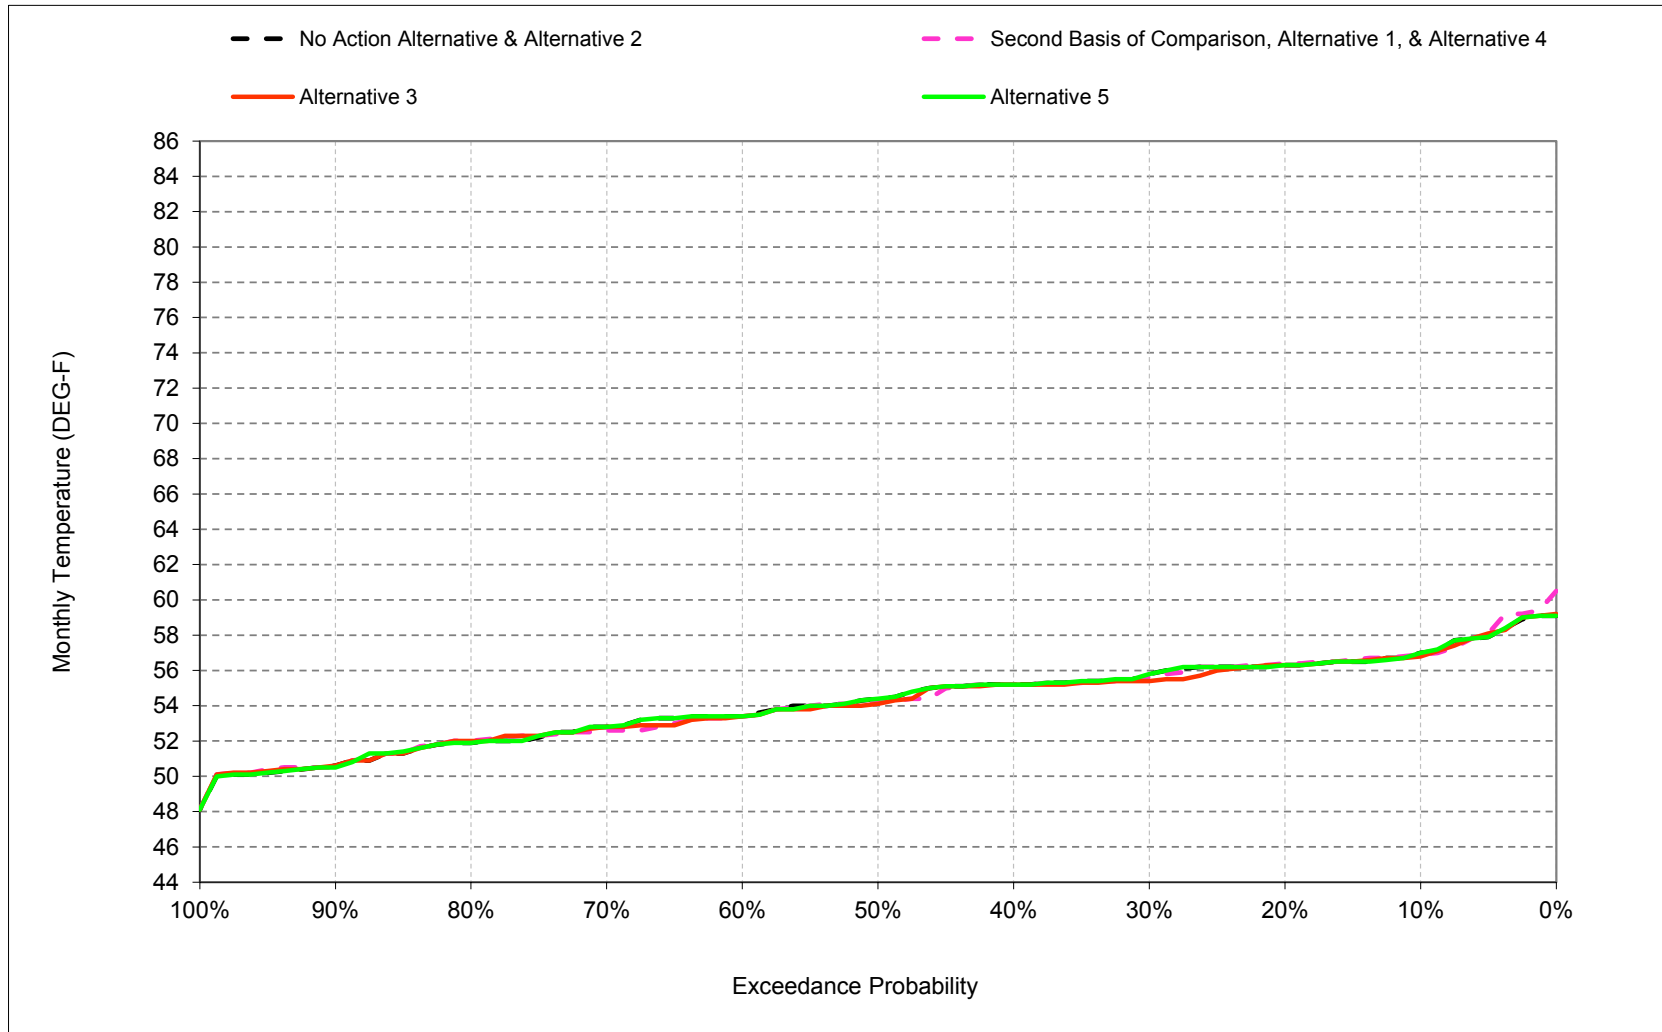


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-22-7. Feather River at Gridley Bridge, April

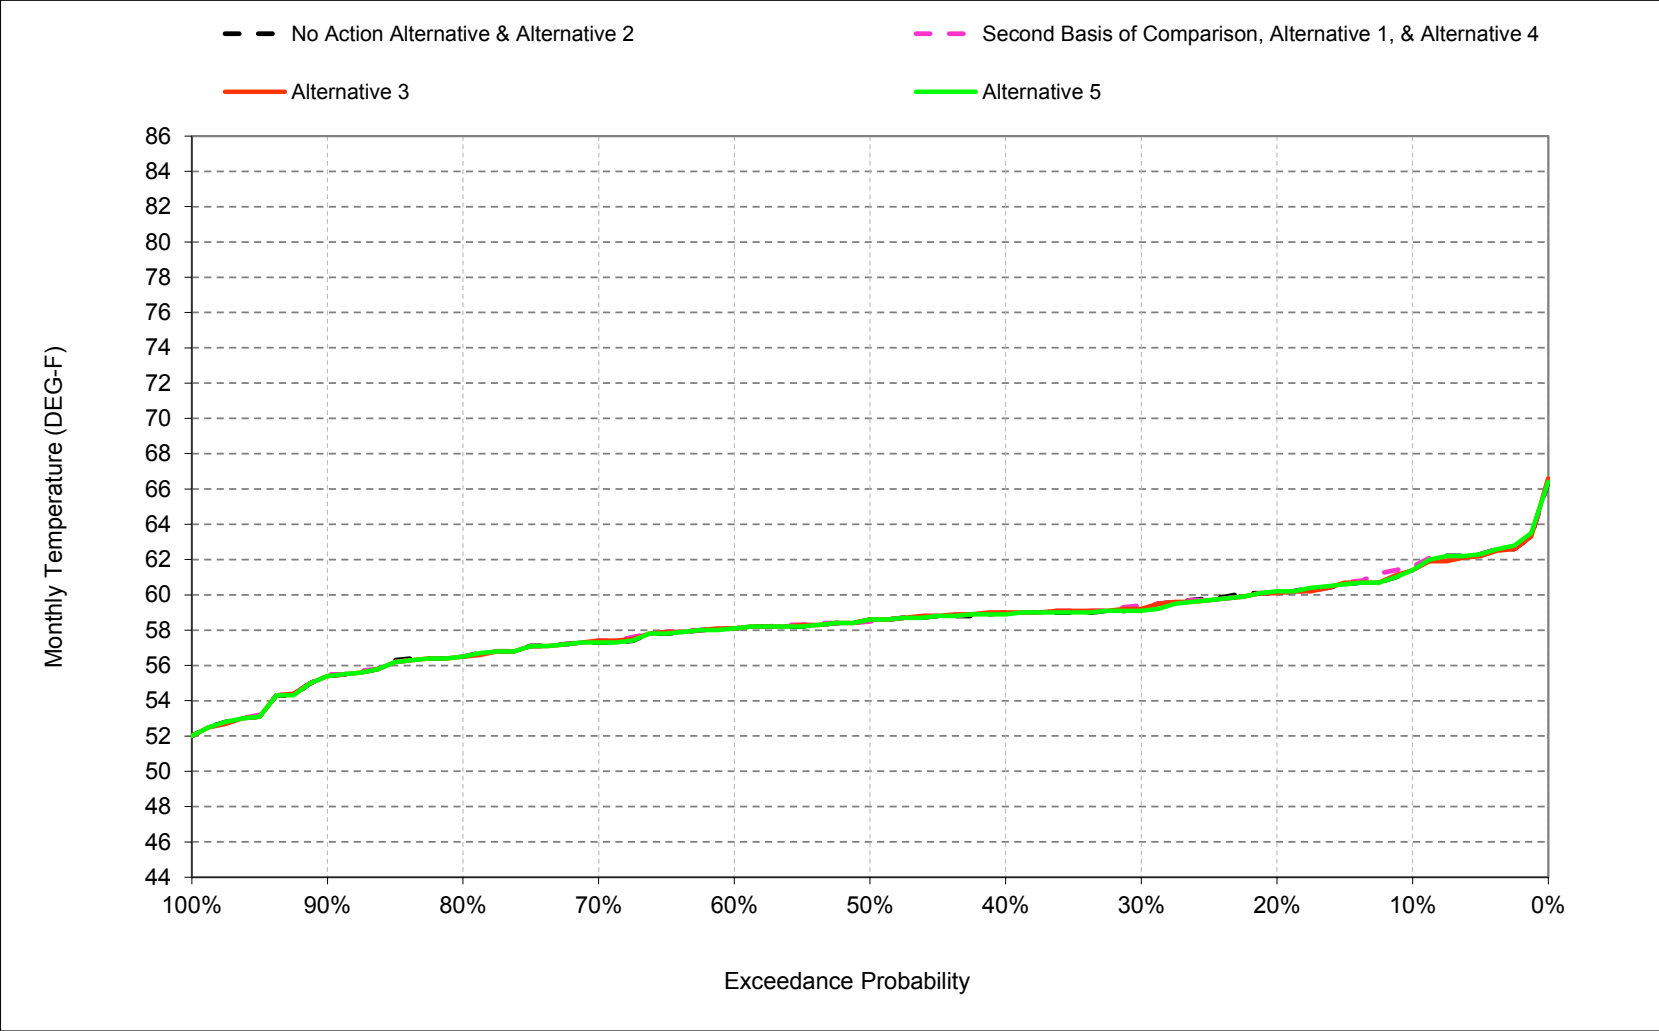


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-22-8. Feather River at Gridley Bridge, May

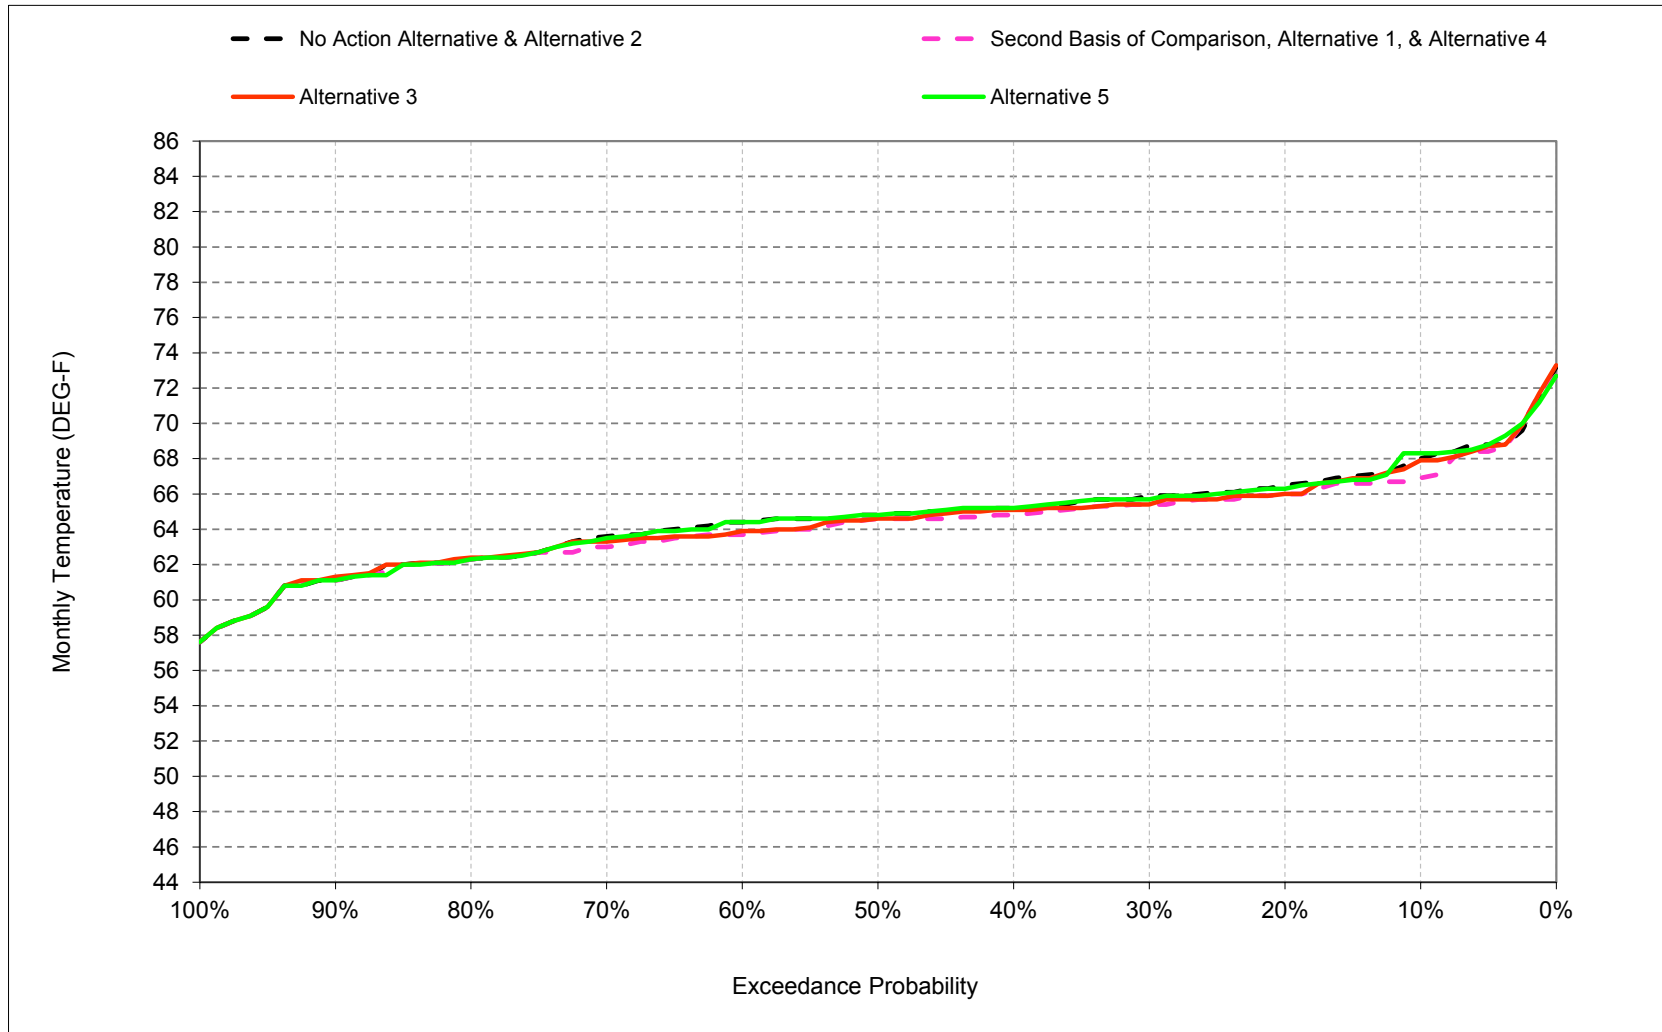


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-22-9. Feather River at Gridley Bridge, June

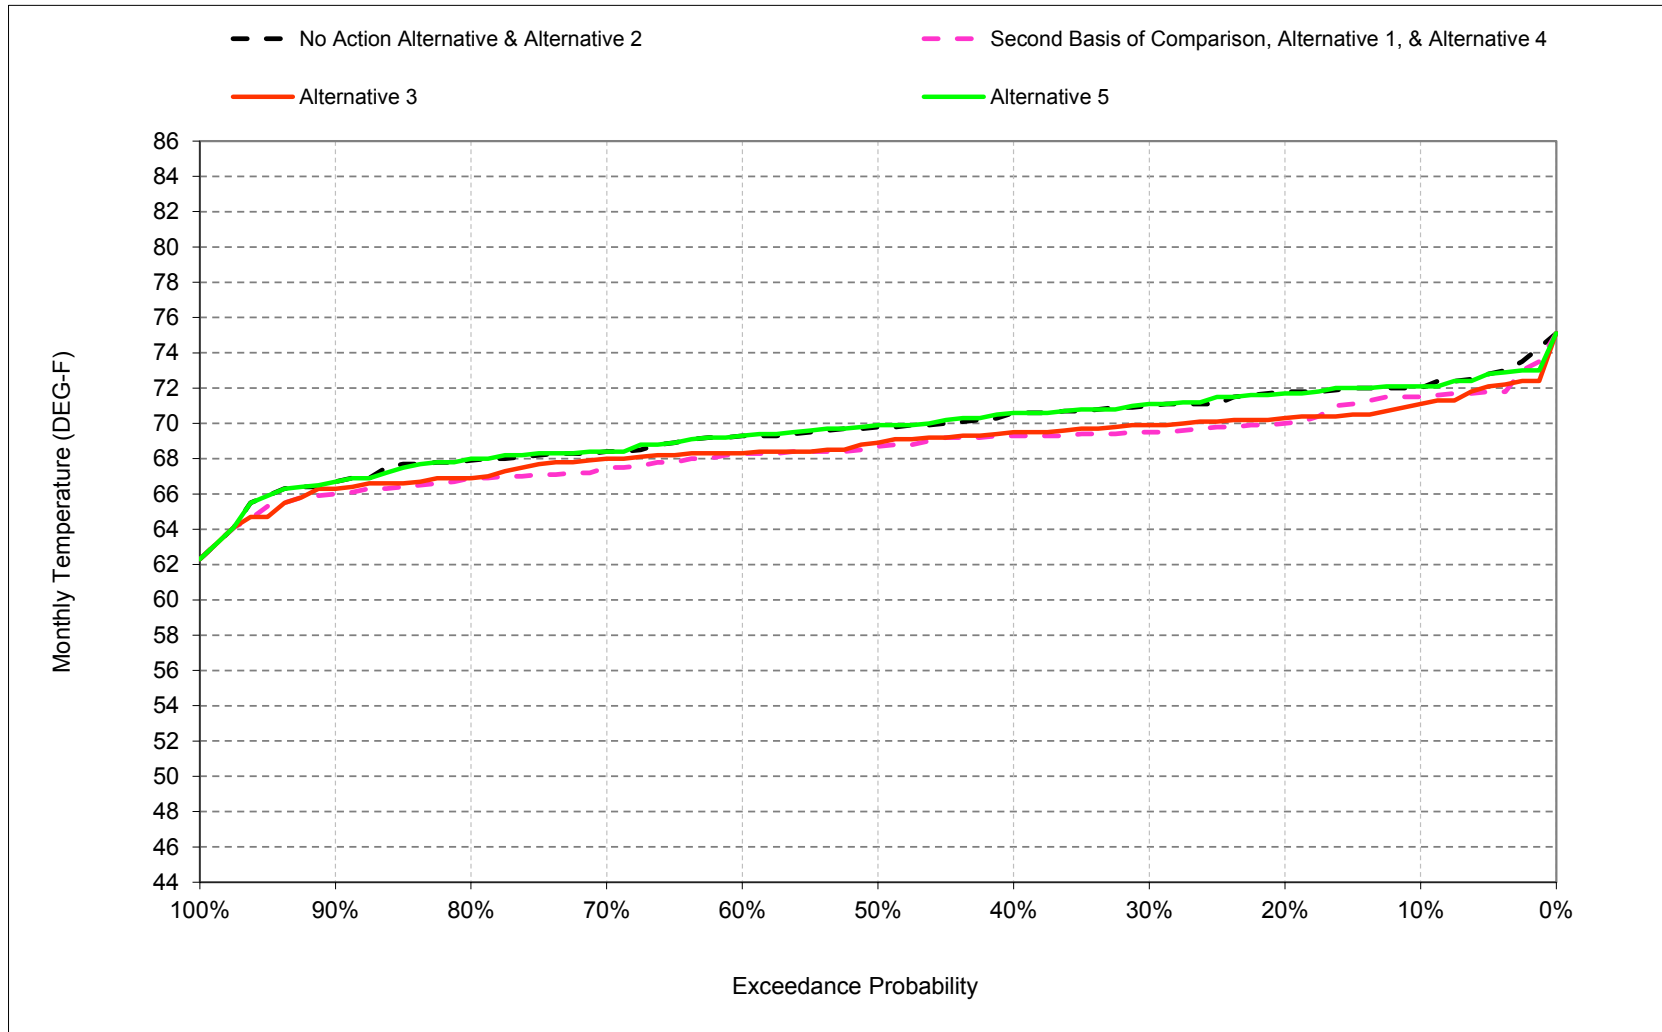


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-22-10. Feather River at Gridley Bridge, July

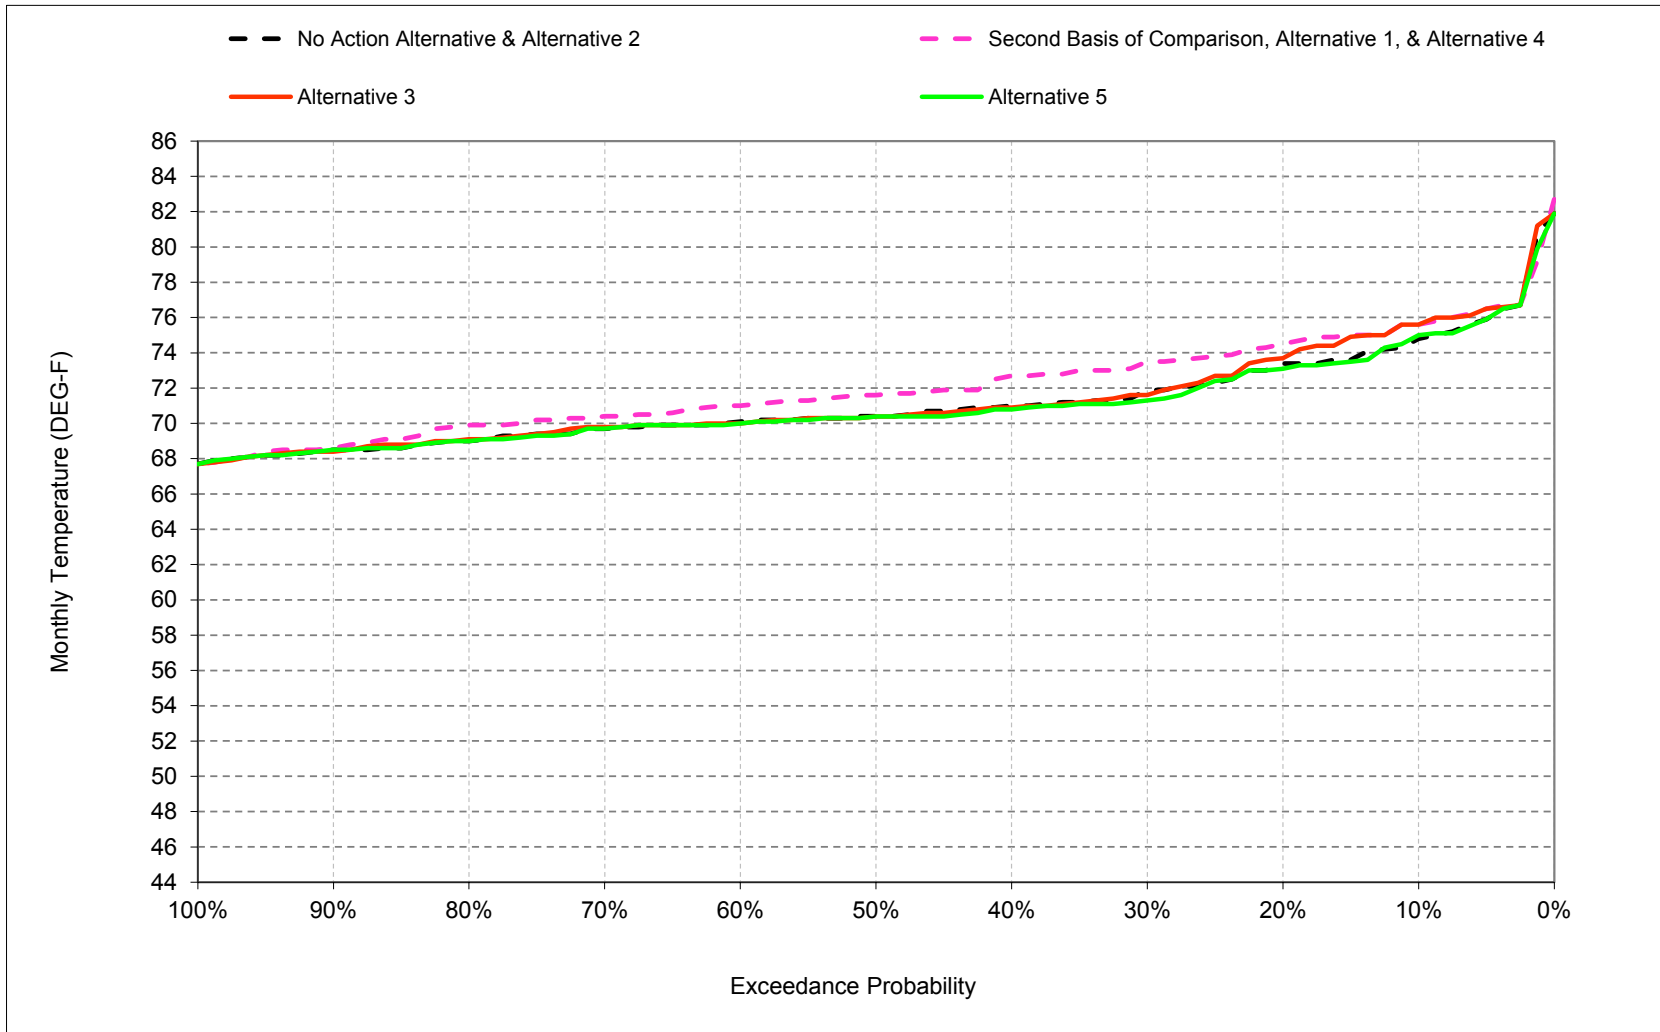


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-22-11. Feather River at Gridley Bridge, August

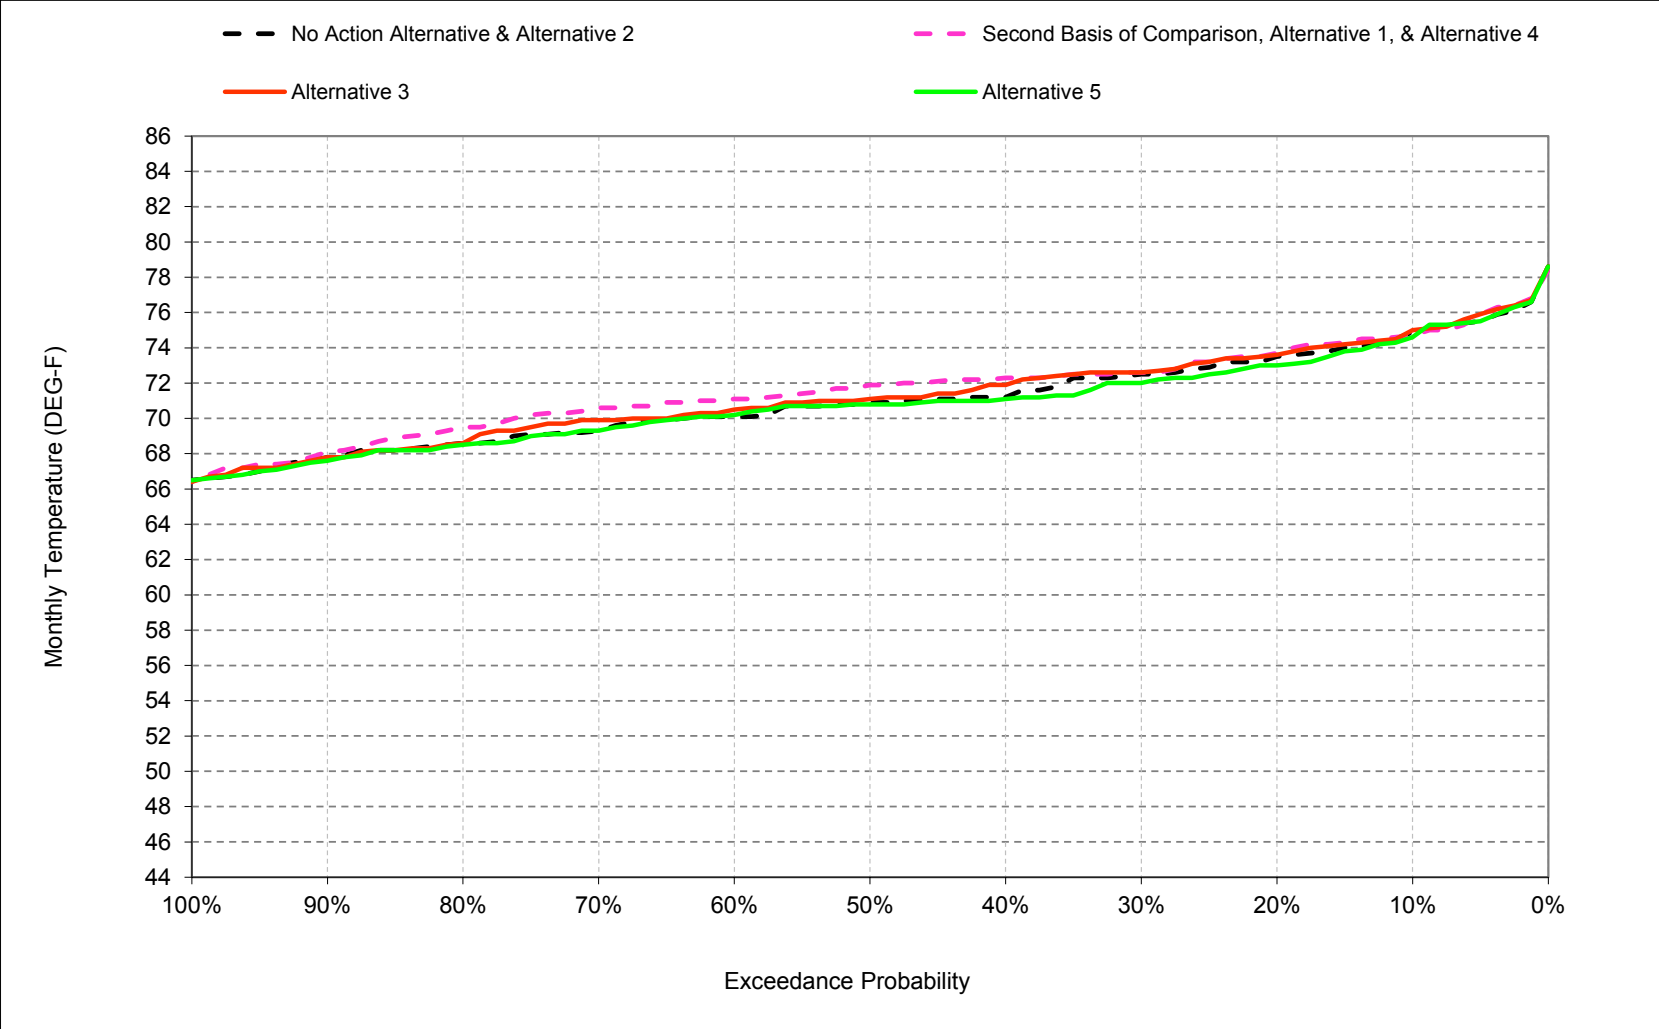

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-22-12. Feather River at Gridley Bridge, September

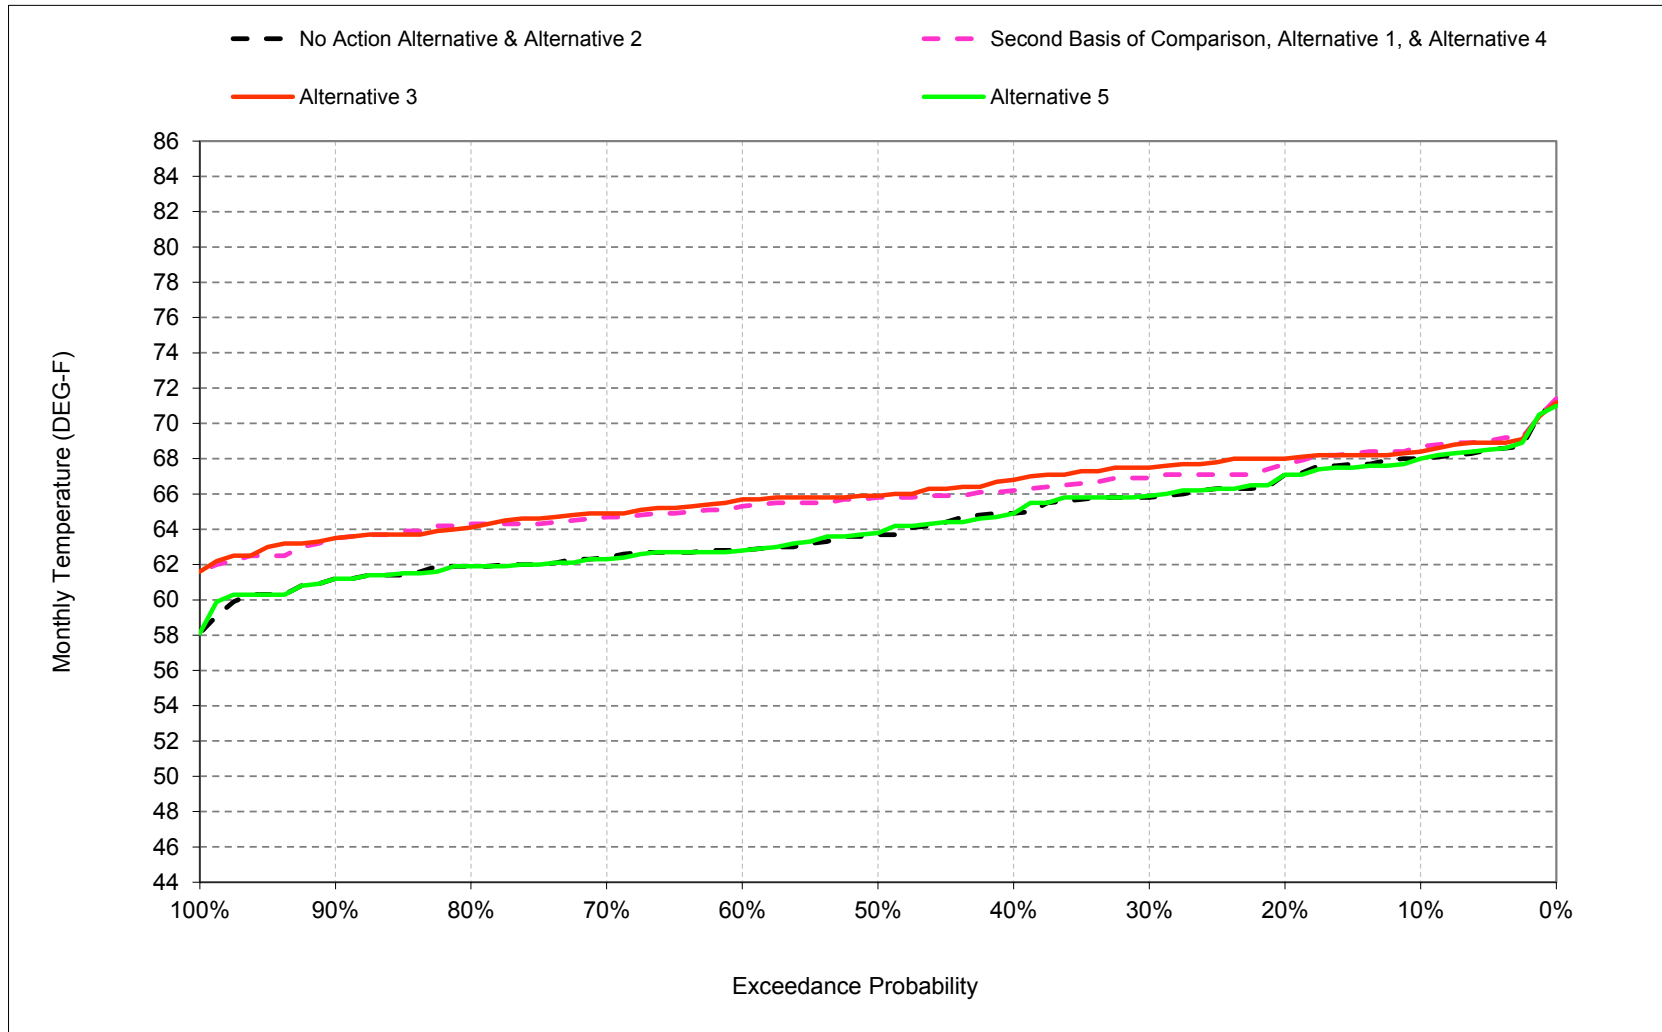

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-22-1. Feather River at Gridley Bridge, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	63	58	52	50	53	57	61	68	72	75	75	68
20%	61	57	51	50	53	56	60	67	72	73	74	67
30%	60	56	50	49	52	56	59	66	71	72	73	66
40%	60	56	50	49	52	55	59	65	71	71	71	65
50%	60	55	50	48	51	54	59	65	70	70	71	64
60%	59	55	49	47	51	53	58	64	69	70	70	63
70%	59	54	49	47	50	53	57	64	68	70	69	62
80%	58	54	48	46	50	52	57	62	68	69	69	62
90%	57	53	47	45	49	51	55	61	67	69	68	61
Long Term												
Full Simulation Period ^b	60	55	50	48	51	54	58	65	70	71	71	64
Water Year Types ^c												
Wet (32%)	57	52	47	48	50	52	56	63	68	71	70	62
Above Normal (16%)	60	56	50	45	48	50	55	60	65	64	63	57
Below Normal (13%)	59	55	50	48	52	55	60	65	70	70	70	66
Dry (24%)	60	55	49	47	51	56	59	66	70	71	72	66
Critical (15%)	61	56	49	48	52	56	59	66	71	75	74	68

Alternative 1												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	58	51	50	53	57	62	67	72	76	75	69
20%	62	57	51	50	53	56	60	66	70	75	74	68
30%	61	56	50	49	52	56	59	65	70	74	73	67
40%	60	55	50	49	52	55	59	65	69	73	72	66
50%	60	55	49	48	51	54	59	65	69	72	72	66
60%	59	54	49	48	51	53	58	64	68	71	71	65
70%	58	53	48	47	50	53	57	63	68	70	71	65
80%	58	53	48	46	50	52	57	62	67	70	70	64
90%	57	53	47	45	49	51	56	61	66	69	68	64
Long Term												
Full Simulation Period ^b	60	55	49	48	51	54	58	64	69	72	72	66
Water Year Types ^c												
Wet (32%)	57	52	47	48	50	52	56	63	68	71	71	66
Above Normal (16%)	61	55	50	45	47	49	54	60	63	64	64	60
Below Normal (13%)	59	54	49	48	51	55	60	64	68	71	72	66
Dry (24%)	60	55	49	47	52	56	59	65	69	73	72	66
Critical (15%)	61	56	49	48	52	56	59	66	70	76	74	68

Alternative 1 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.7	0.0	-0.3	-0.1	0.0	-0.1	0.2	-1.1	-0.5	0.8	-0.2	0.7
0.2	0.8	0.0	-0.4	0.0	0.0	0.1	0.0	-0.5	-1.8	1.1	0.2	0.6
0.3	0.3	-0.2	-0.2	0.2	0.1	-0.2	0.2	-0.5	-1.5	1.6	0.1	1.1
0.4	0.2	-0.3	-0.3	0.1	-0.1	0.0	0.0	-0.4	-1.3	1.7	1.1	1.3
0.5	-0.1	-0.3	-0.4	-0.1	0.1	-0.2	-0.1	-0.2	-1.1	1.2	1.0	2.1
0.6	0.0	-0.7	-0.5	0.1	0.0	0.0	0.0	-0.7	-1.0	0.9	1.0	2.5
0.7	-0.3	-0.8	-0.4	0.1	0.2	-0.2	0.1	-0.6	-0.9	0.7	1.3	2.3
0.8	-0.2	-0.9	-0.4	-0.1	-0.1	0.1	0.0	0.0	-1.0	0.9	0.9	2.4
0.9	0.1	0.0	-0.3	0.0	0.0	-0.1	0.1	0.0	-0.7	0.1	0.3	2.3
Long Term												
Full Simulation Period ^b	0.0	-0.3	-0.4	0.1	0.0	0.0	0.0	-0.3	-1.0	0.9	0.6	1.6
Water Year Types ^c												
Wet (32%)	-0.2	-0.5	-0.1	0.2	0.1	0.0	0.0	0.0	-0.3	0.6	1.0	3.9
Above Normal (16%)	0.3	-0.2	-0.6	0.0	-0.2	-0.3	-0.1	-0.5	-1.5	0.4	0.9	2.1
Below Normal (13%)	0.0	-0.6	-0.9	0.0	-0.2	0.0	0.0	-1.0	-2.7	0.9	1.6	0.0
Dry (24%)	0.1	-0.3	-0.4	0.0	0.1	0.1	0.1	-0.4	-1.0	1.8	-0.4	0.1
Critical (15%)	0.2	0.5	-0.3	0.0	-0.1	0.2	0.1	-0.1	-0.4	0.4	-0.2	0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-22-2. Feather River at Gridley Bridge, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	63	58	52	50	53	57	61	68	72	75	75	68
20%	61	57	51	50	53	56	60	67	72	73	74	67
30%	60	56	50	49	52	56	59	66	71	72	73	66
40%	60	56	50	49	52	55	59	65	71	71	71	65
50%	60	55	50	48	51	54	59	65	70	70	71	64
60%	59	55	49	47	51	53	58	64	69	70	70	63
70%	59	54	49	47	50	53	57	64	68	70	69	62
80%	58	54	48	46	50	52	57	62	68	69	69	62
90%	57	53	47	45	49	51	55	61	67	69	68	61
Long Term												
Full Simulation Period ^b	60	55	50	48	51	54	58	65	70	71	71	64
Water Year Types ^c												
Wet (32%)	57	52	47	48	50	52	56	63	68	71	70	62
Above Normal (16%)	60	56	50	45	48	50	55	60	65	64	63	57
Below Normal (13%)	59	55	50	48	52	55	60	65	70	70	70	66
Dry (24%)	60	55	49	47	51	56	59	66	70	71	72	66
Critical (15%)	61	56	49	48	52	56	59	66	71	75	74	68

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	58	51	50	53	57	61	68	71	76	75	68
20%	61	57	51	50	53	56	60	66	70	74	74	68
30%	61	56	50	49	52	55	59	65	70	72	73	68
40%	60	55	50	49	52	55	59	65	70	71	72	67
50%	59	54	50	48	51	54	59	65	69	70	71	66
60%	59	54	49	47	51	53	58	64	68	70	71	66
70%	59	53	48	47	50	53	57	63	68	70	70	65
80%	58	53	48	46	50	52	57	62	67	69	69	64
90%	57	52	47	45	49	51	55	61	66	68	68	64
Long Term												
Full Simulation Period ^b	60	55	49	48	51	54	58	64	69	71	71	66
Water Year Types ^c												
Wet (32%)	57	52	47	48	50	52	56	63	68	71	71	66
Above Normal (16%)	60	55	50	45	48	49	54	60	64	64	64	60
Below Normal (13%)	59	54	49	48	51	55	60	65	69	70	70	67
Dry (24%)	60	55	49	47	51	56	59	66	69	72	72	66
Critical (15%)	60	56	49	48	52	55	59	66	70	76	74	67

Alternative 3 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.6	-0.1	-0.4	0.0	0.1	-0.2	0.0	-0.1	-0.9	0.8	0.1	0.4
0.2	0.6	0.0	-0.4	0.0	0.1	0.0	0.0	-0.5	-1.5	0.3	0.1	0.9
0.3	0.1	-0.2	0.0	0.1	0.2	-0.4	0.0	-0.5	-1.1	-0.3	0.1	1.7
0.4	-0.1	-0.2	-0.1	0.0	-0.1	0.0	0.0	-0.1	-1.1	-0.1	0.7	1.9
0.5	-0.3	-0.8	-0.3	0.0	0.1	-0.3	0.0	-0.2	-0.9	0.0	0.2	2.2
0.6	0.1	-0.8	-0.3	0.0	-0.1	0.0	0.0	-0.5	-1.0	-0.1	0.4	2.9
0.7	0.0	-0.8	-0.3	0.0	0.1	0.0	0.1	-0.3	-0.4	0.1	0.6	2.5
0.8	0.0	-0.8	-0.2	-0.1	-0.1	0.1	0.0	0.1	-1.0	0.1	0.0	2.2
0.9	0.0	-0.2	-0.6	0.0	0.0	0.0	0.0	0.2	-0.4	-0.1	0.0	2.3
Long Term												
Full Simulation Period ^b	0.0	-0.4	-0.3	0.0	0.0	-0.1	0.0	-0.2	-0.9	0.2	0.2	1.9
Water Year Types ^c												
Wet (32%)	-0.1	-0.5	-0.1	0.1	0.0	0.0	0.0	-0.1	-0.6	0.1	0.8	4.1
Above Normal (16%)	-0.1	-0.4	-0.5	0.0	0.0	-0.2	-0.2	-0.4	-0.9	0.0	0.4	2.4
Below Normal (13%)	0.1	-0.6	-1.0	0.0	-0.2	0.0	-0.1	-0.4	-1.3	-0.4	-0.5	0.8
Dry (24%)	0.2	-0.4	-0.3	0.0	0.0	0.0	0.0	-0.2	-1.2	0.6	0.0	0.3
Critical (15%)	-0.3	0.0	-0.1	0.0	0.0	-0.1	0.1	0.1	-0.6	0.3	-0.1	-0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-22-3. Feather River at Gridley Bridge, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	63	58	52	50	53	57	61	68	72	75	75	68
20%	61	57	51	50	53	56	60	67	72	73	74	67
30%	60	56	50	49	52	56	59	66	71	72	73	66
40%	60	56	50	49	52	55	59	65	71	71	71	65
50%	60	55	50	48	51	54	59	65	70	70	71	64
60%	59	55	49	47	51	53	58	64	69	70	70	63
70%	59	54	49	47	50	53	57	64	68	70	69	62
80%	58	54	48	46	50	52	57	62	68	69	69	62
90%	57	53	47	45	49	51	55	61	67	69	68	61
Long Term												
Full Simulation Period ^b	60	55	50	48	51	54	58	65	70	71	71	64
Water Year Types ^c												
Wet (32%)	57	52	47	48	50	52	56	63	68	71	70	62
Above Normal (16%)	60	56	50	45	48	50	55	60	65	64	63	57
Below Normal (13%)	59	55	50	48	52	55	60	65	70	70	70	66
Dry (24%)	60	55	49	47	51	56	59	66	70	71	72	66
Critical (15%)	61	56	49	48	52	56	59	66	71	75	74	68

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	58	52	50	53	57	61	68	72	75	75	68
20%	61	57	51	50	53	56	60	66	72	73	73	67
30%	61	56	50	49	52	56	59	66	71	71	72	66
40%	60	56	50	48	52	55	59	65	71	71	71	65
50%	60	55	50	48	51	54	59	65	70	70	71	64
60%	59	55	49	48	51	53	58	64	69	70	70	63
70%	59	54	49	47	50	53	57	64	68	70	69	62
80%	58	54	48	46	50	52	57	62	68	69	69	62
90%	57	53	47	45	49	51	55	61	67	69	68	61
Long Term												
Full Simulation Period ^b	60	55	50	48	51	54	58	65	70	71	71	64
Water Year Types ^c												
Wet (32%)	57	52	47	48	50	52	56	63	68	71	70	62
Above Normal (16%)	60	55	50	45	48	50	55	60	65	64	63	57
Below Normal (13%)	59	55	50	48	52	55	60	65	71	70	70	66
Dry (24%)	60	55	49	47	51	56	59	66	70	71	72	66
Critical (15%)	61	56	49	48	52	56	59	65	71	75	74	67

Alternative 5 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	-0.6	-0.3	0.0	0.0	-0.2	0.0	0.0	0.3	0.1	0.2	-0.3	0.0
0.2	0.0	-0.1	0.1	0.0	0.0	0.0	0.1	-0.2	-0.1	-0.3	-0.5	0.0
0.3	0.1	0.0	0.1	0.0	0.1	0.0	-0.1	-0.2	0.1	-0.6	-0.5	0.1
0.4	0.0	0.0	0.0	-0.1	0.0	0.0	-0.1	0.0	0.0	-0.2	-0.1	0.0
0.5	0.1	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	-0.1	0.1
0.6	0.1	0.0	0.1	0.1	-0.1	0.0	0.0	0.0	0.0	-0.1	0.1	0.0
0.7	0.0	-0.1	-0.1	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	0.0	-0.1
0.8	0.0	-0.2	0.0	-0.1	0.0	0.0	0.0	0.0	0.1	0.0	-0.1	0.0
0.9	0.0	0.0	0.0	-0.1	0.0	-0.1	0.0	0.0	0.0	0.0	-0.2	0.0
Long Term												
Full Simulation Period ^b	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.2	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	-0.2	0.0
Above Normal (16%)	0.0	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	-0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	-0.4	0.1
Dry (24%)	-0.1	-0.2	0.0	0.0	0.0	0.0	0.0	0.1	-0.1	-0.2	-0.1	0.1
Critical (15%)	-0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.2	0.1	0.0	-0.1	-0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-22-4. Feather River at Gridley Bridge, Monthly Temperature

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	62	58	51	50	53	57	62	67	72	76	75	69
20%	62	57	51	50	53	56	60	66	70	75	74	68
30%	61	56	50	49	52	56	59	65	70	74	73	67
40%	60	55	50	49	52	55	59	65	69	73	72	66
50%	60	55	49	48	51	54	59	65	69	72	72	66
60%	59	54	49	48	51	53	58	64	68	71	71	65
70%	58	53	48	47	50	53	57	63	68	70	71	65
80%	58	53	48	46	50	52	57	62	67	70	70	64
90%	57	53	47	45	49	51	56	61	66	69	68	64
Long Term												
Full Simulation Period ^b	60	55	49	48	51	54	58	64	69	72	72	66
Water Year Types ^c												
Wet (32%)	57	52	47	48	50	52	56	63	68	71	71	66
Above Normal (16%)	61	55	50	45	47	49	54	60	63	64	64	60
Below Normal (13%)	59	54	49	48	51	55	60	64	68	71	72	66
Dry (24%)	60	55	49	47	52	56	59	65	69	73	72	66
Critical (15%)	61	56	49	48	52	56	59	66	70	76	74	68

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance ^a												
10%	63	58	52	50	53	57	61	68	72	75	75	68
20%	61	57	51	50	53	56	60	67	72	73	74	67
30%	60	56	50	49	52	56	59	66	71	72	73	66
40%	60	56	50	49	52	55	59	65	71	71	71	65
50%	60	55	50	48	51	54	59	65	70	70	71	64
60%	59	55	49	47	51	53	58	64	69	70	70	63
70%	59	54	49	47	50	53	57	64	68	70	69	62
80%	58	54	48	46	50	52	57	62	68	69	69	62
90%	57	53	47	45	49	51	55	61	67	69	68	61
Long Term												
Full Simulation Period ^b	60	55	50	48	51	54	58	65	70	71	71	64
Water Year Types ^c												
Wet (32%)	57	52	47	48	50	52	56	63	68	71	70	62
Above Normal (16%)	60	56	50	45	48	50	55	60	65	64	63	57
Below Normal (13%)	59	55	50	48	52	55	60	65	70	70	70	66
Dry (24%)	60	55	49	47	51	56	59	66	70	71	72	66
Critical (15%)	61	56	49	48	52	56	59	66	71	75	74	68

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative minus Second Basis of Comparison												
Probability of Exceedance ^a												
0.1	0.7	0.0	0.3	0.1	0.0	0.1	-0.2	1.1	0.5	-0.8	0.2	-0.7
0.2	-0.8	0.0	0.4	0.0	0.0	-0.1	0.0	0.5	1.8	-1.1	-0.2	-0.6
0.3	-0.3	0.2	0.2	-0.2	-0.1	0.2	-0.2	0.5	1.5	-1.6	-0.1	-1.1
0.4	-0.2	0.3	0.3	-0.1	0.1	0.0	0.0	0.4	1.3	-1.7	-1.1	-1.3
0.5	0.1	0.3	0.4	0.1	-0.1	0.2	0.1	0.2	1.1	-1.2	-1.0	-2.1
0.6	0.0	0.7	0.5	-0.1	0.0	0.0	0.0	0.7	1.0	-0.9	-1.0	-2.5
0.7	0.3	0.8	0.4	-0.1	-0.2	0.2	-0.1	0.6	0.9	-0.7	-1.3	-2.3
0.8	0.2	0.9	0.4	0.1	0.1	-0.1	0.0	0.0	1.0	-0.9	-0.9	-2.4
0.9	-0.1	0.0	0.3	0.0	0.0	0.1	-0.1	0.0	0.7	-0.1	-0.3	-2.3
Long Term												
Full Simulation Period ^b	0.0	0.3	0.4	-0.1	0.0	0.0	0.0	0.3	1.0	-0.9	-0.6	-1.6
Water Year Types ^c												
Wet (32%)	0.2	0.5	0.1	-0.2	-0.1	0.0	0.0	0.0	0.3	-0.6	-1.0	-3.9
Above Normal (16%)	-0.3	0.2	0.6	0.0	0.2	0.3	0.1	0.5	1.5	-0.4	-0.9	-2.1
Below Normal (13%)	0.0	0.6	0.9	0.0	0.2	0.0	0.0	1.0	2.7	-0.9	-1.6	0.0
Dry (24%)	-0.1	0.3	0.4	0.0	-0.1	-0.1	-0.1	0.4	1.0	-1.8	0.4	-0.1
Critical (15%)	-0.2	-0.5	0.3	0.0	0.1	-0.2	-0.1	0.1	0.4	-0.4	0.2	-0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-22-5. Feather River at Gridley Bridge, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	58	51	50	53	57	62	67	72	76	75	69
20%	62	57	51	50	53	56	60	66	70	75	74	68
30%	61	56	50	49	52	56	59	65	70	74	73	67
40%	60	55	50	49	52	55	59	65	69	73	72	66
50%	60	55	49	48	51	54	59	65	69	72	72	66
60%	59	54	49	48	51	53	58	64	68	71	71	65
70%	58	53	48	47	50	53	57	63	68	70	71	65
80%	58	53	48	46	50	52	57	62	67	70	70	64
90%	57	53	47	45	49	51	56	61	66	69	68	64
Long Term												
Full Simulation Period ^b	60	55	49	48	51	54	58	64	69	72	72	66
Water Year Types ^c												
Wet (32%)	57	52	47	48	50	52	56	63	68	71	71	66
Above Normal (16%)	61	55	50	45	47	49	54	60	63	64	64	60
Below Normal (13%)	59	54	49	48	51	55	60	64	68	71	72	66
Dry (24%)	60	55	49	47	52	56	59	65	69	73	72	66
Critical (15%)	61	56	49	48	52	56	59	66	70	76	74	68

Alternative 3

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	62	58	51	50	53	57	61	68	71	76	75	68
20%	61	57	51	50	53	56	60	66	70	74	74	68
30%	61	56	50	49	52	55	59	65	70	72	73	68
40%	60	55	50	49	52	55	59	65	70	71	72	67
50%	59	54	50	48	51	54	59	65	69	70	71	66
60%	59	54	49	47	51	53	58	64	68	70	71	66
70%	59	53	48	47	50	53	57	63	68	70	70	65
80%	58	53	48	46	50	52	57	62	67	69	69	64
90%	57	52	47	45	49	51	55	61	66	68	68	64
Long Term												
Full Simulation Period ^b	60	55	49	48	51	54	58	64	69	71	71	66
Water Year Types ^c												
Wet (32%)	57	52	47	48	50	52	56	63	68	71	71	66
Above Normal (16%)	60	55	50	45	48	49	54	60	64	64	64	60
Below Normal (13%)	59	54	49	48	51	55	60	65	69	70	70	67
Dry (24%)	60	55	49	47	51	56	59	66	69	72	72	66
Critical (15%)	60	56	49	48	52	55	59	66	70	76	74	67

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.1	-0.1	-0.1	0.1	0.1	-0.1	-0.2	1.0	-0.4	0.0	0.3	-0.3
0.2	-0.2	0.0	0.0	0.0	0.1	-0.1	0.0	0.0	0.3	-0.8	-0.1	0.3
0.3	-0.2	0.0	0.2	-0.1	0.1	-0.2	-0.2	0.0	0.4	-1.9	0.0	0.6
0.4	-0.3	0.1	0.2	-0.1	0.0	0.0	0.0	0.3	0.2	-1.8	-0.4	0.6
0.5	-0.2	-0.5	0.1	0.1	0.0	-0.1	0.1	0.0	0.2	-1.2	-0.8	0.1
0.6	0.1	-0.1	0.2	-0.1	-0.1	0.0	0.0	0.2	0.0	-1.0	-0.6	0.4
0.7	0.3	0.0	0.1	-0.1	-0.1	0.2	0.0	0.3	0.5	-0.6	-0.7	0.2
0.8	0.2	0.1	0.2	0.0	0.0	0.0	0.0	0.1	0.0	-0.8	-0.9	-0.2
0.9	-0.1	-0.2	-0.3	0.0	0.0	0.1	-0.1	0.2	0.3	-0.2	-0.3	0.0
Long Term												
Full Simulation Period ^b	-0.1	-0.1	0.0	0.0	0.0	-0.1	0.0	0.2	0.1	-0.7	-0.3	0.2
Water Year Types ^c												
Wet (32%)	0.1	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	-0.3	-0.5	-0.3	0.3
Above Normal (16%)	-0.3	-0.2	0.2	0.0	0.2	0.1	0.0	0.1	0.6	-0.5	-0.5	0.2
Below Normal (13%)	0.1	0.0	-0.1	0.0	0.0	0.0	-0.1	0.6	1.5	-1.3	-2.1	0.8
Dry (24%)	0.1	-0.1	0.1	0.0	-0.1	-0.1	0.0	0.2	-0.2	-1.2	0.5	0.2
Critical (15%)	-0.5	-0.5	0.2	-0.1	0.1	-0.4	0.0	0.2	-0.2	-0.1	0.1	-0.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-22-6. Feather River at Gridley Bridge, Monthly Temperature

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance^a												
10%	62	58	51	50	53	57	62	67	72	76	75	69
20%	62	57	51	50	53	56	60	66	70	75	74	68
30%	61	56	50	49	52	56	59	65	70	74	73	67
40%	60	55	50	49	52	55	59	65	69	73	72	66
50%	60	55	49	48	51	54	59	65	69	72	72	66
60%	59	54	49	48	51	53	58	64	68	71	71	65
70%	58	53	48	47	50	53	57	63	68	70	71	65
80%	58	53	48	46	50	52	57	62	67	70	70	64
90%	57	53	47	45	49	51	56	61	66	69	68	64
Long Term												
Full Simulation Period ^b	60	55	49	48	51	54	58	64	69	72	72	66
Water Year Types^c												
Wet (32%)	57	52	47	48	50	52	56	63	68	71	71	66
Above Normal (16%)	61	55	50	45	47	49	54	60	63	64	64	60
Below Normal (13%)	59	54	49	48	51	55	60	64	68	71	72	66
Dry (24%)	60	55	49	47	52	56	59	65	69	73	72	66
Critical (15%)	61	56	49	48	52	56	59	66	70	76	74	68

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 5												
Probability of Exceedance^a												
10%	62	58	52	50	53	57	61	68	72	75	75	68
20%	61	57	51	50	53	56	60	66	72	73	73	67
30%	61	56	50	49	52	56	59	66	71	71	72	66
40%	60	56	50	48	52	55	59	65	71	71	71	65
50%	60	55	50	48	51	54	59	65	70	70	71	64
60%	59	55	49	48	51	53	58	64	69	70	70	63
70%	59	54	49	47	50	53	57	64	68	70	69	62
80%	58	54	48	46	50	52	57	62	68	69	69	62
90%	57	53	47	45	49	51	55	61	67	69	68	61
Long Term												
Full Simulation Period ^b	60	55	50	48	51	54	58	65	70	71	71	64
Water Year Types^c												
Wet (32%)	57	52	47	48	50	52	56	63	68	71	70	62
Above Normal (16%)	60	55	50	45	48	50	55	60	65	64	63	57
Below Normal (13%)	59	55	50	48	52	55	60	65	71	70	70	66
Dry (24%)	60	55	49	47	51	56	59	66	70	71	72	66
Critical (15%)	61	56	49	48	52	56	59	65	71	75	74	67

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 5 minus Second Basis of Comparison												
Probability of Exceedance^a												
0.1	0.1	-0.3	0.3	0.1	-0.2	0.1	-0.2	1.4	0.6	-0.6	-0.1	-0.7
0.2	-0.8	-0.1	0.5	0.0	0.0	-0.1	0.1	0.3	1.7	-1.4	-0.7	-0.6
0.3	-0.2	0.2	0.3	-0.2	0.0	0.2	-0.3	0.3	1.6	-2.2	-0.6	-1.0
0.4	-0.2	0.3	0.3	-0.2	0.1	0.0	-0.1	0.4	1.3	-1.9	-1.2	-1.3
0.5	0.2	0.2	0.3	0.1	-0.1	0.2	0.1	0.2	1.2	-1.2	-1.1	-2.0
0.6	0.1	0.7	0.6	0.0	-0.1	0.0	0.0	0.7	1.0	-1.0	-0.9	-2.5
0.7	0.3	0.7	0.3	-0.1	-0.2	0.2	-0.1	0.5	0.9	-0.7	-1.3	-2.4
0.8	0.2	0.7	0.4	0.0	0.1	-0.1	0.0	0.0	1.1	-0.9	-1.0	-2.4
0.9	-0.1	0.0	0.3	-0.1	0.0	0.0	-0.1	0.0	0.7	-0.1	-0.5	-2.3
Long Term												
Full Simulation Period ^b	-0.1	0.2	0.4	-0.1	0.0	0.0	0.0	0.3	1.0	-1.0	-0.7	-1.6
Water Year Types^c												
Wet (32%)	0.2	0.6	0.1	-0.2	-0.1	0.0	0.0	0.0	0.4	-0.7	-1.2	-3.8
Above Normal (16%)	-0.3	0.1	0.6	-0.1	0.2	0.3	0.1	0.5	1.5	-0.5	-0.9	-2.1
Below Normal (13%)	-0.1	0.5	0.9	0.1	0.2	0.0	0.0	1.0	2.8	-1.0	-2.0	0.1
Dry (24%)	-0.2	0.1	0.4	0.0	-0.1	-0.1	-0.1	0.5	0.9	-2.0	0.3	0.0
Critical (15%)	-0.3	-0.5	0.4	0.0	0.1	-0.2	-0.2	-0.1	0.5	-0.5	0.0	-0.3

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


^b Based on an 81-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


B.23. Feather River at Mouth

Figure B-23-1. Feather River at Mouth, October

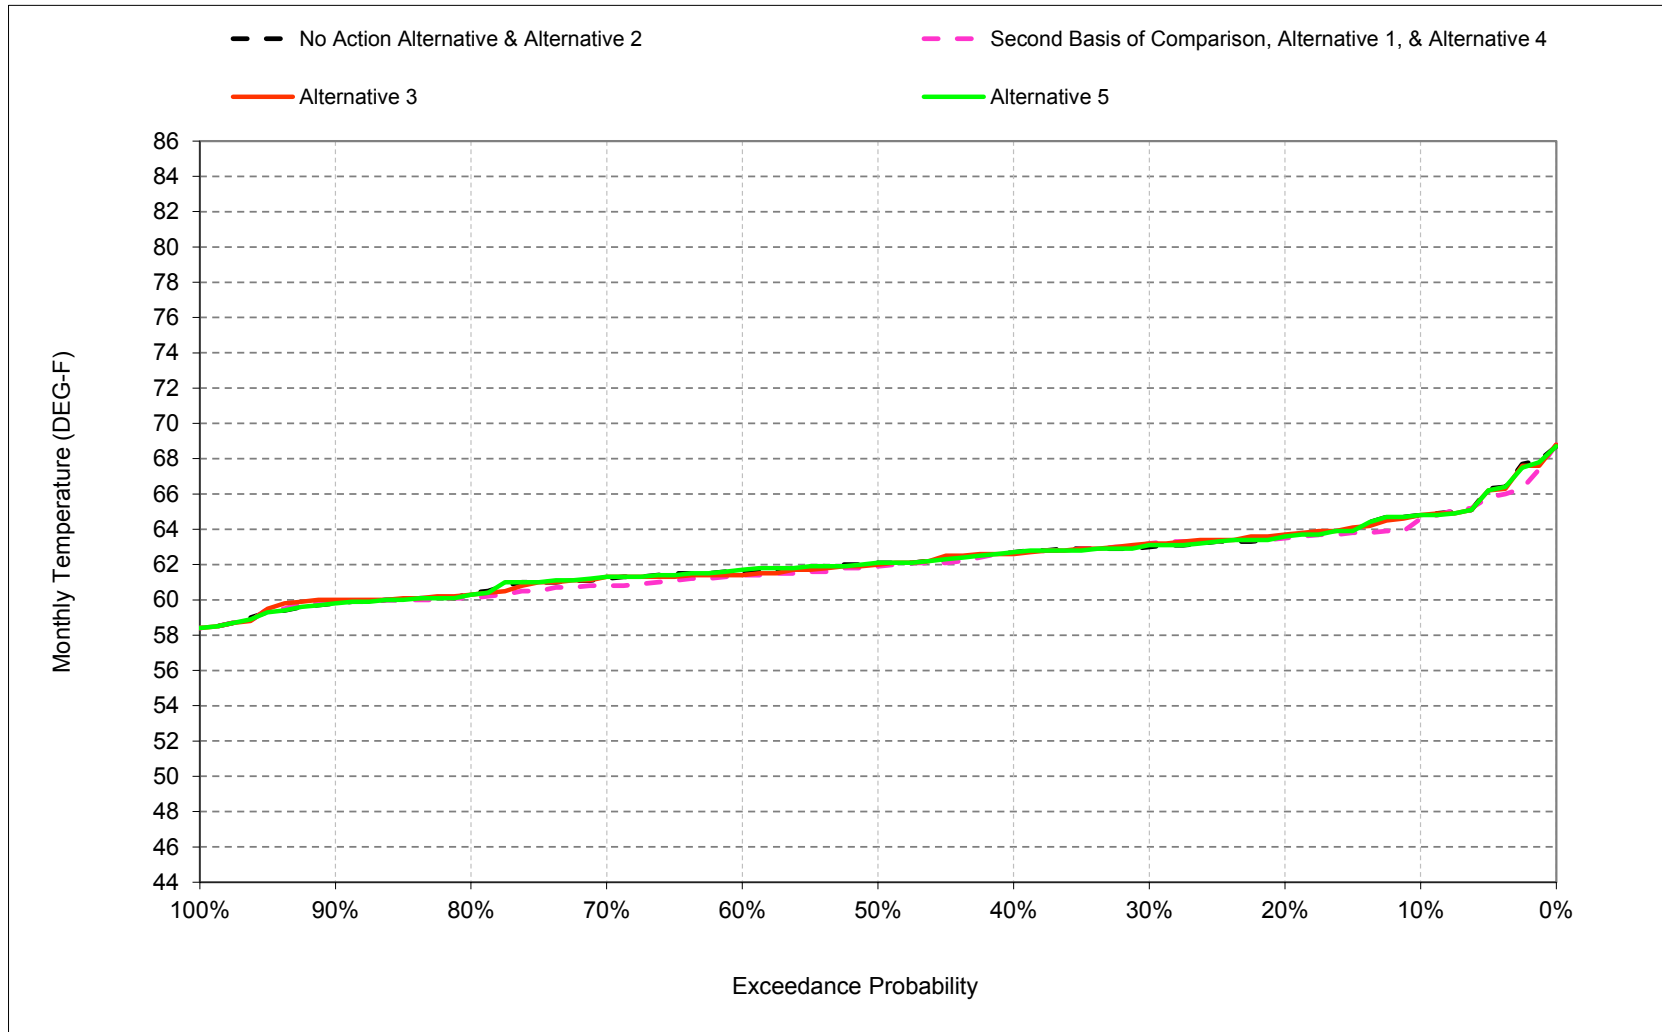


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-23-2. Feather River at Mouth, November

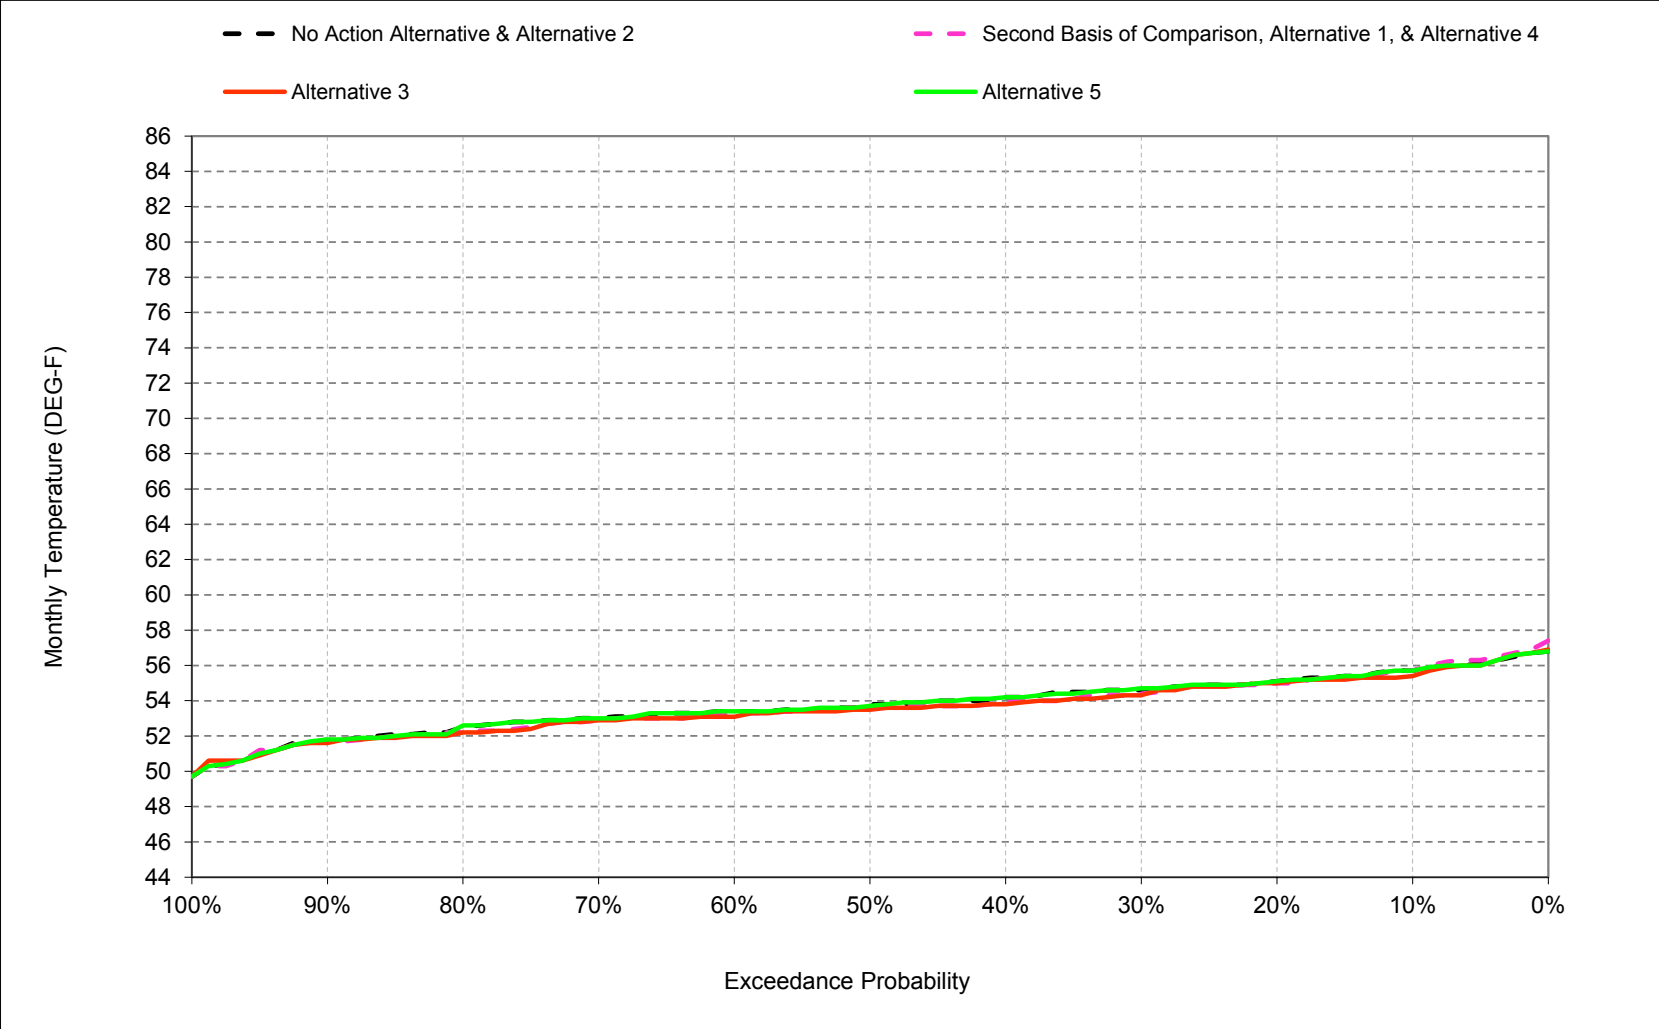


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-23-3. Feather River at Mouth, December

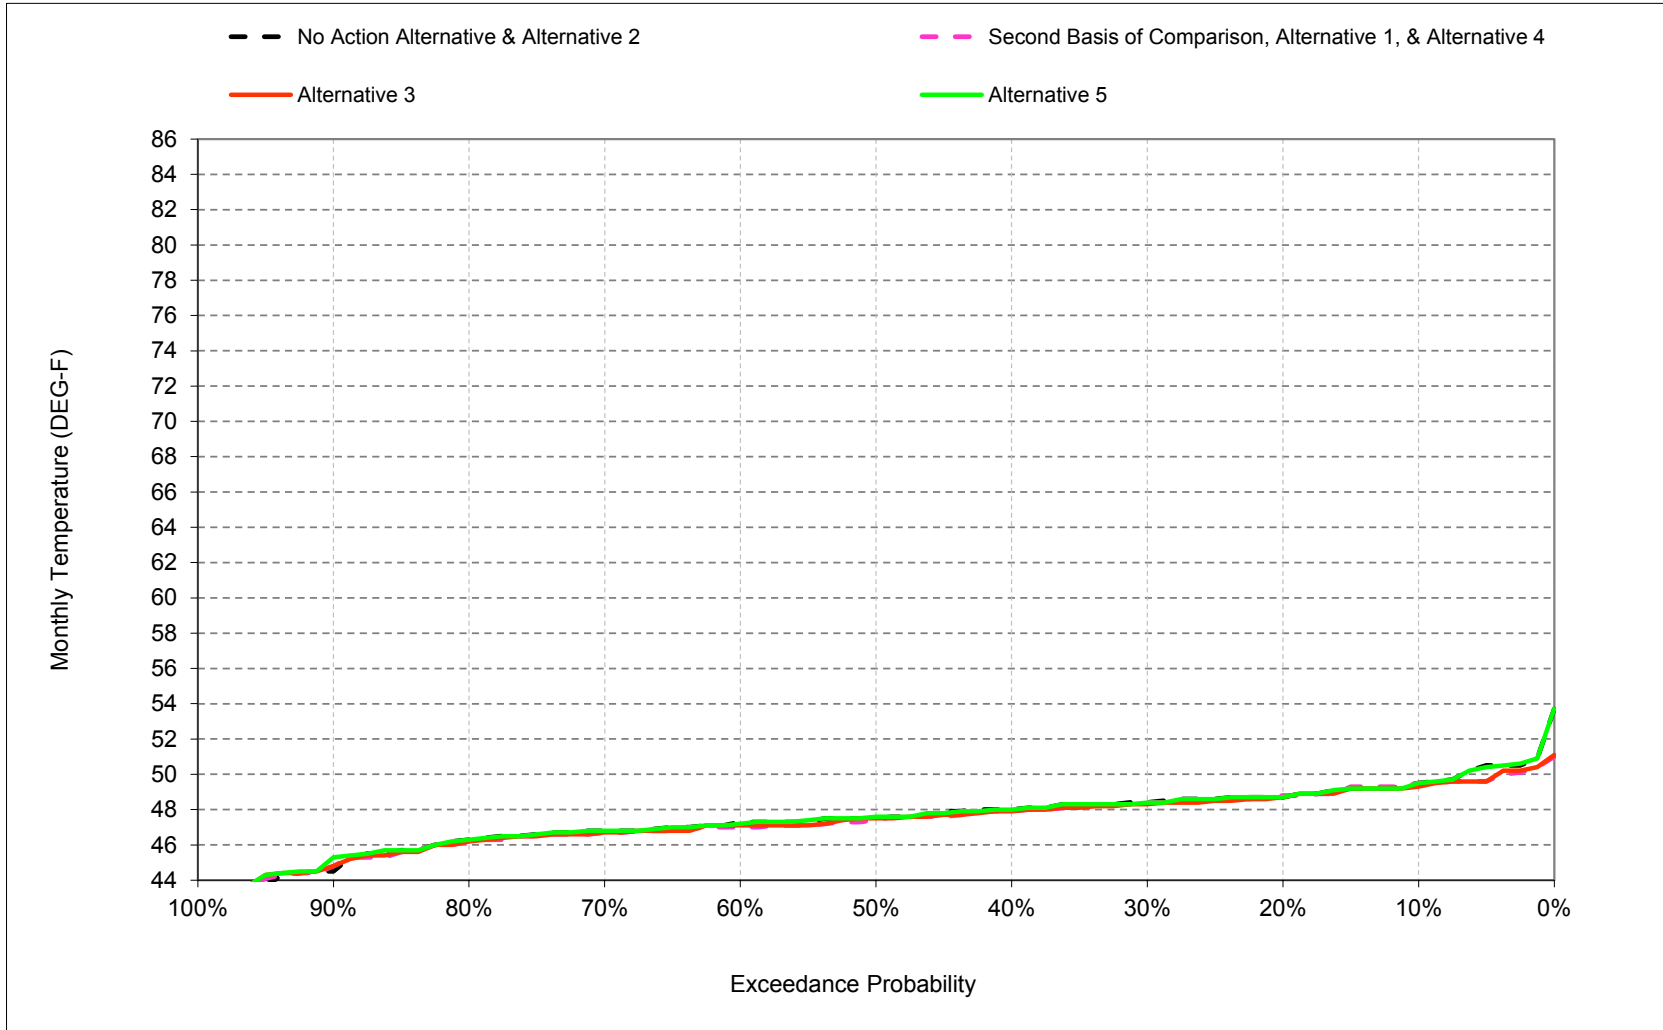


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-23-4. Feather River at Mouth, January

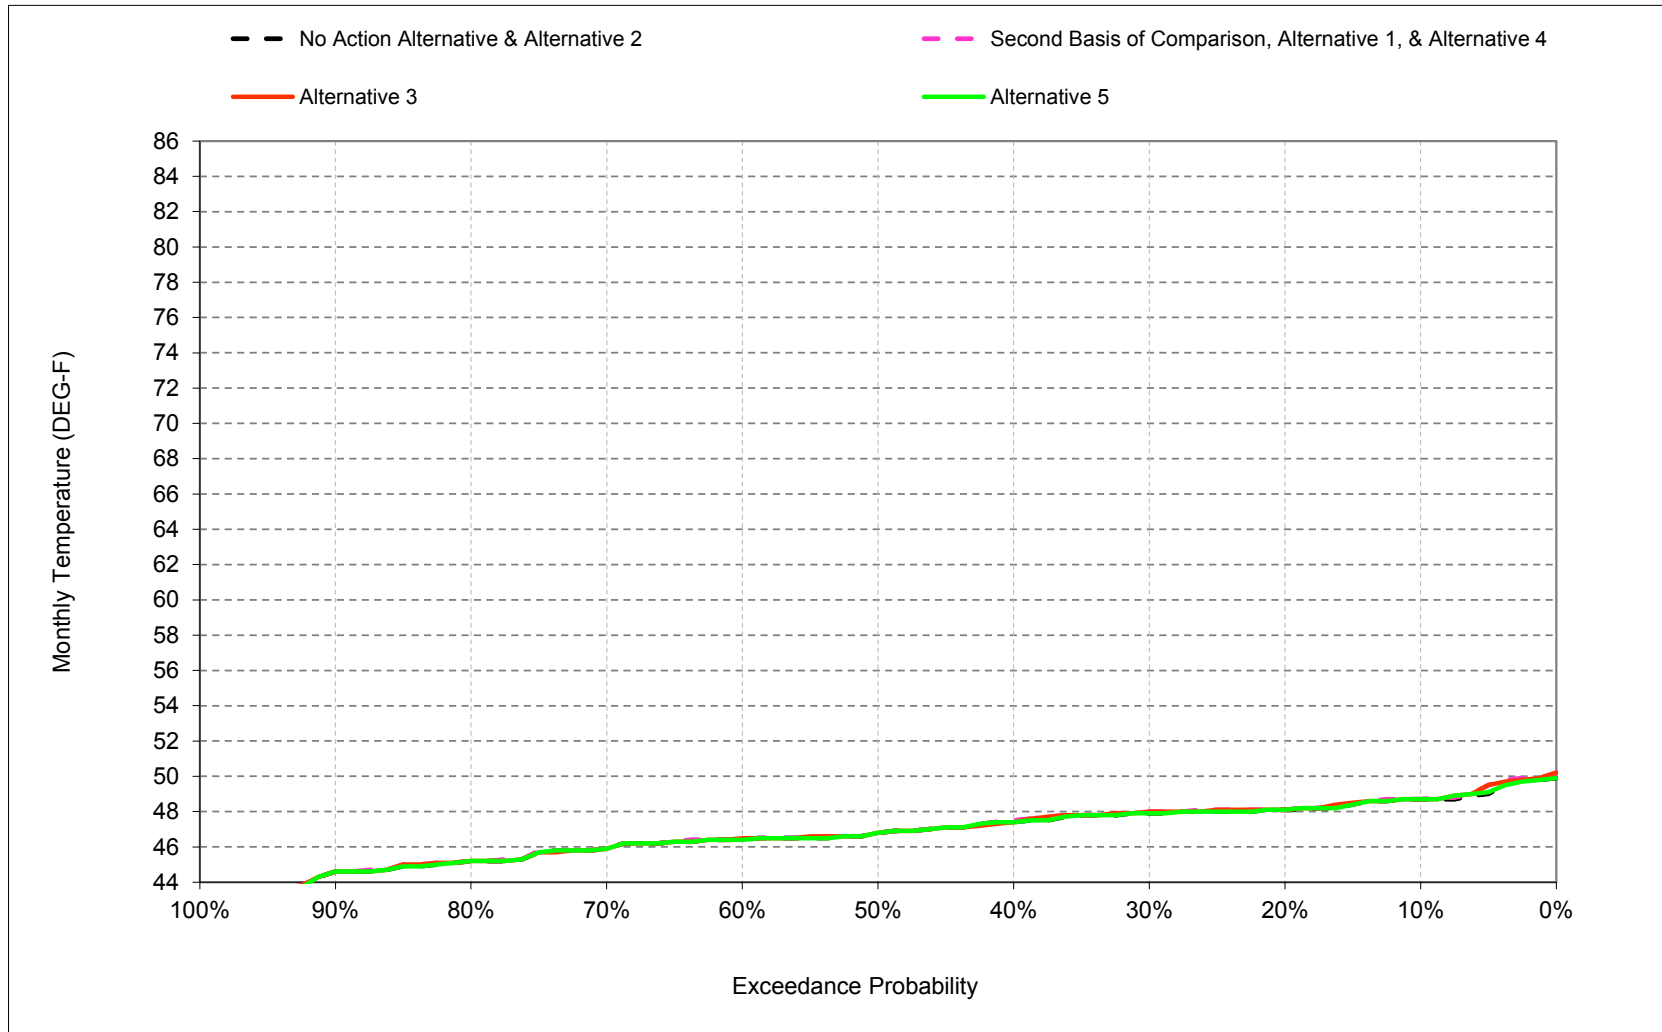


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-23-5. Feather River at Mouth, February

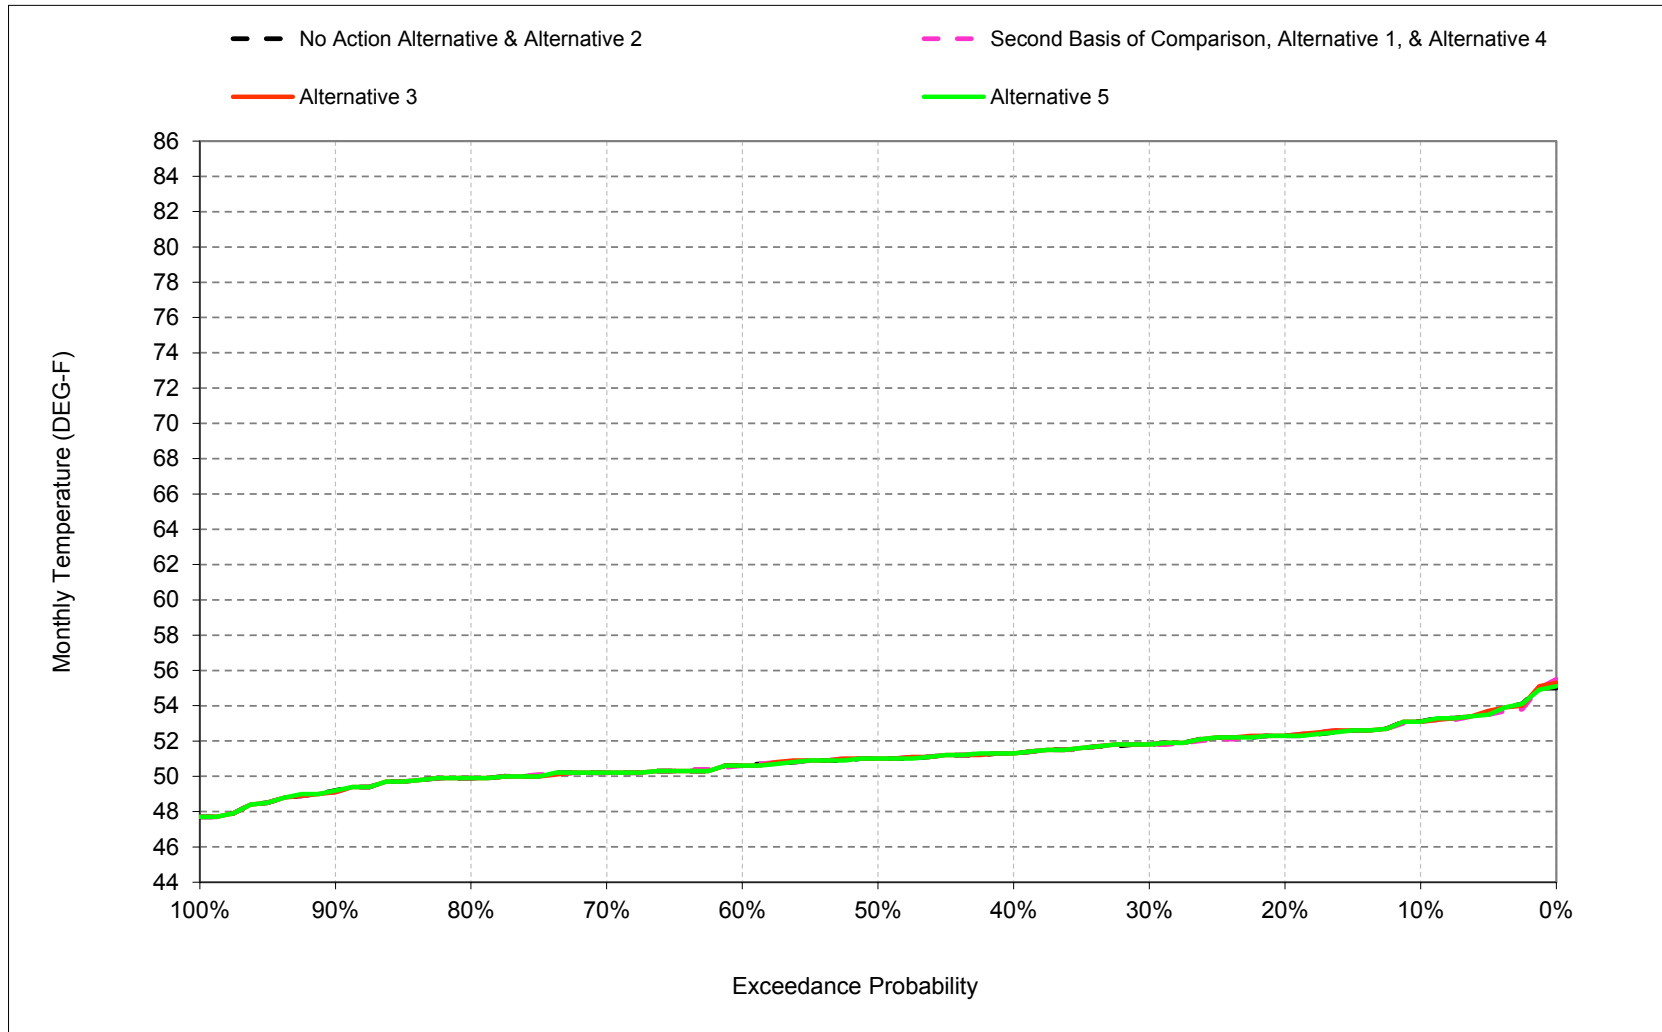


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-23-6. Feather River at Mouth, March

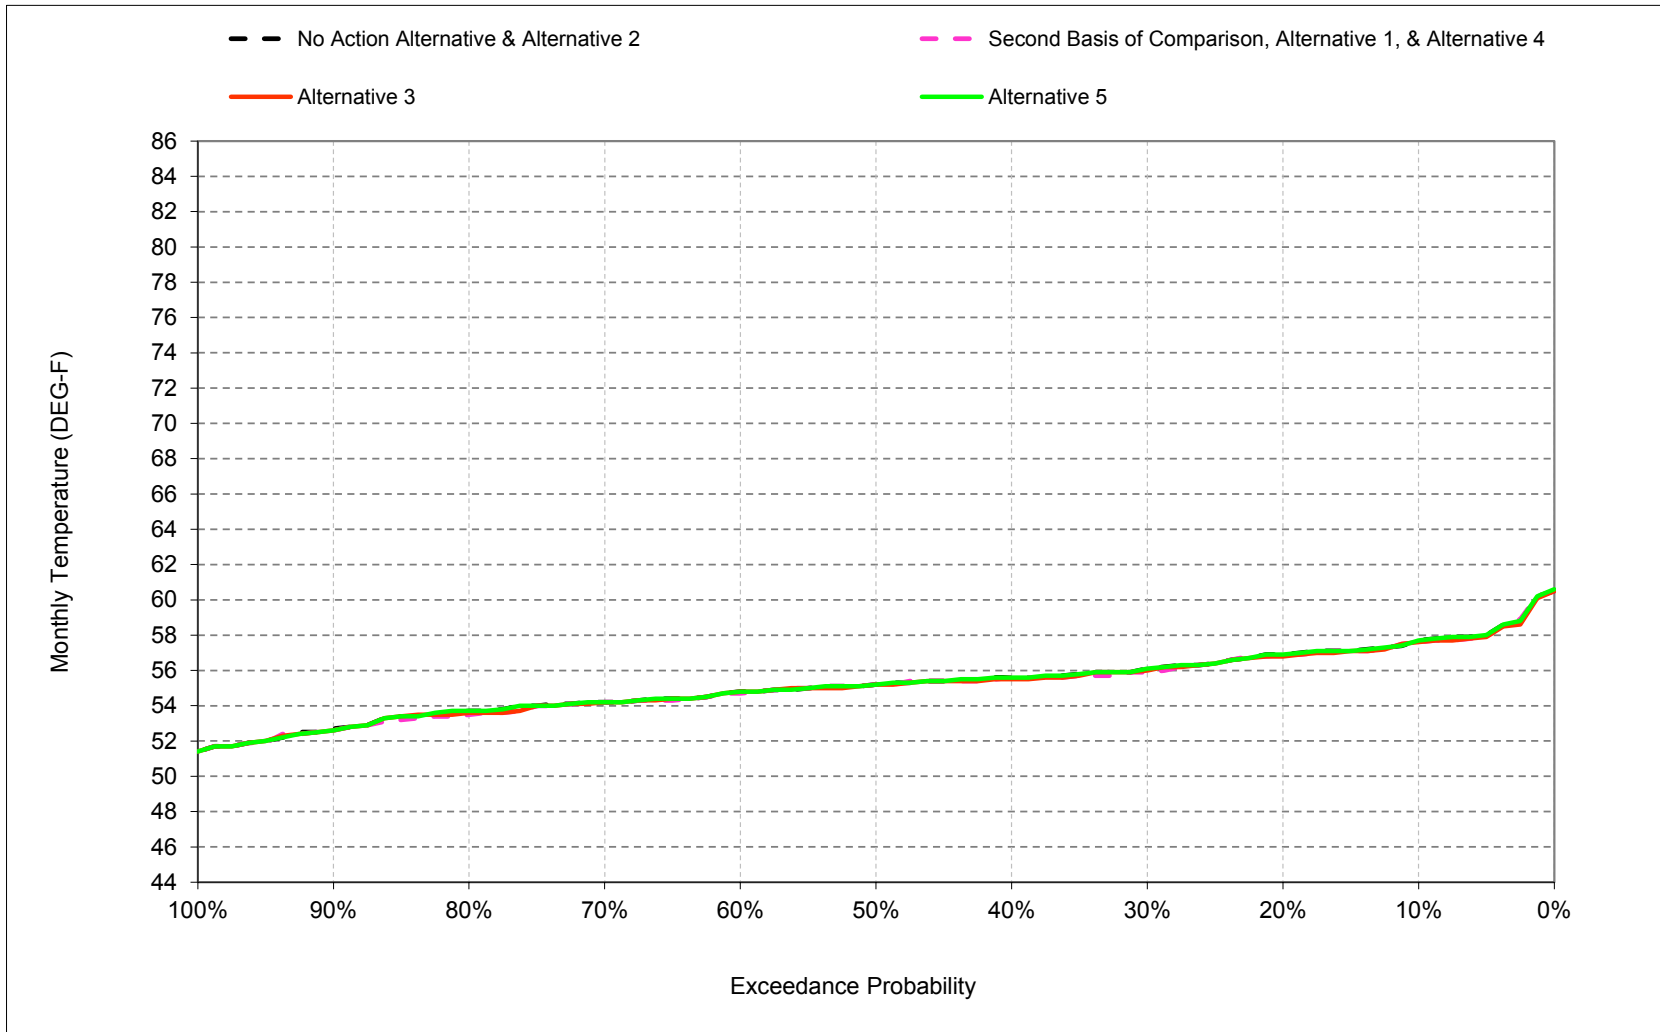


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-23-7. Feather River at Mouth, April

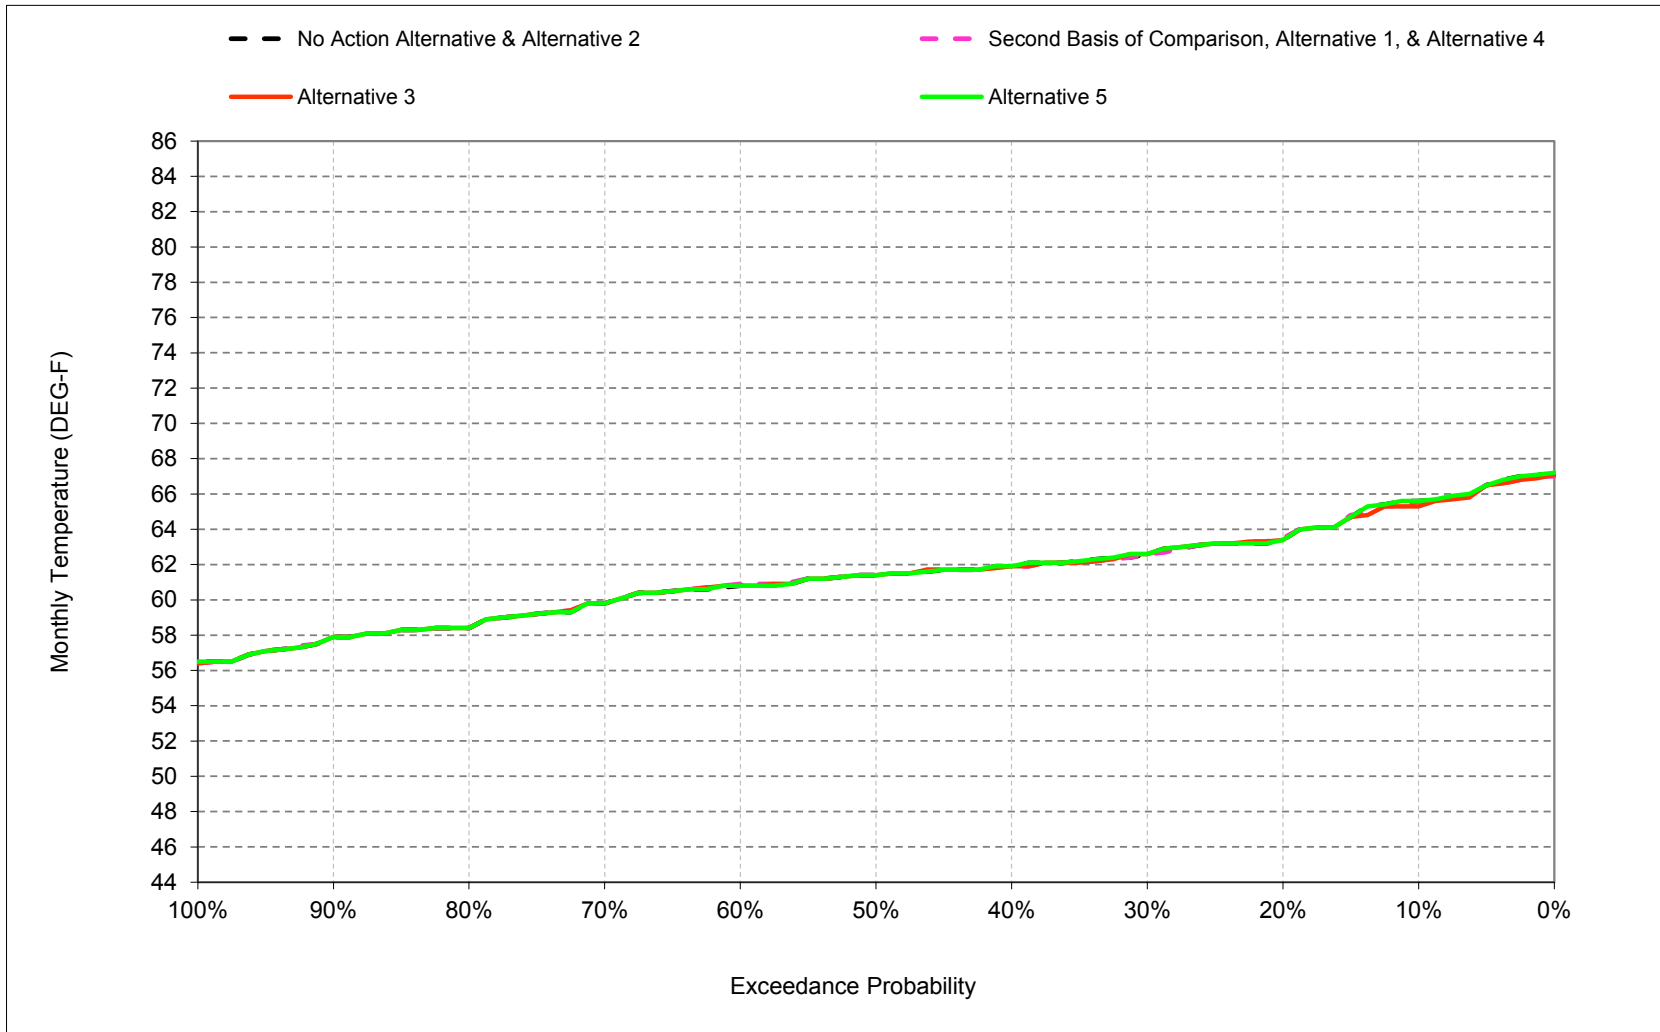


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-23-8. Feather River at Mouth, May

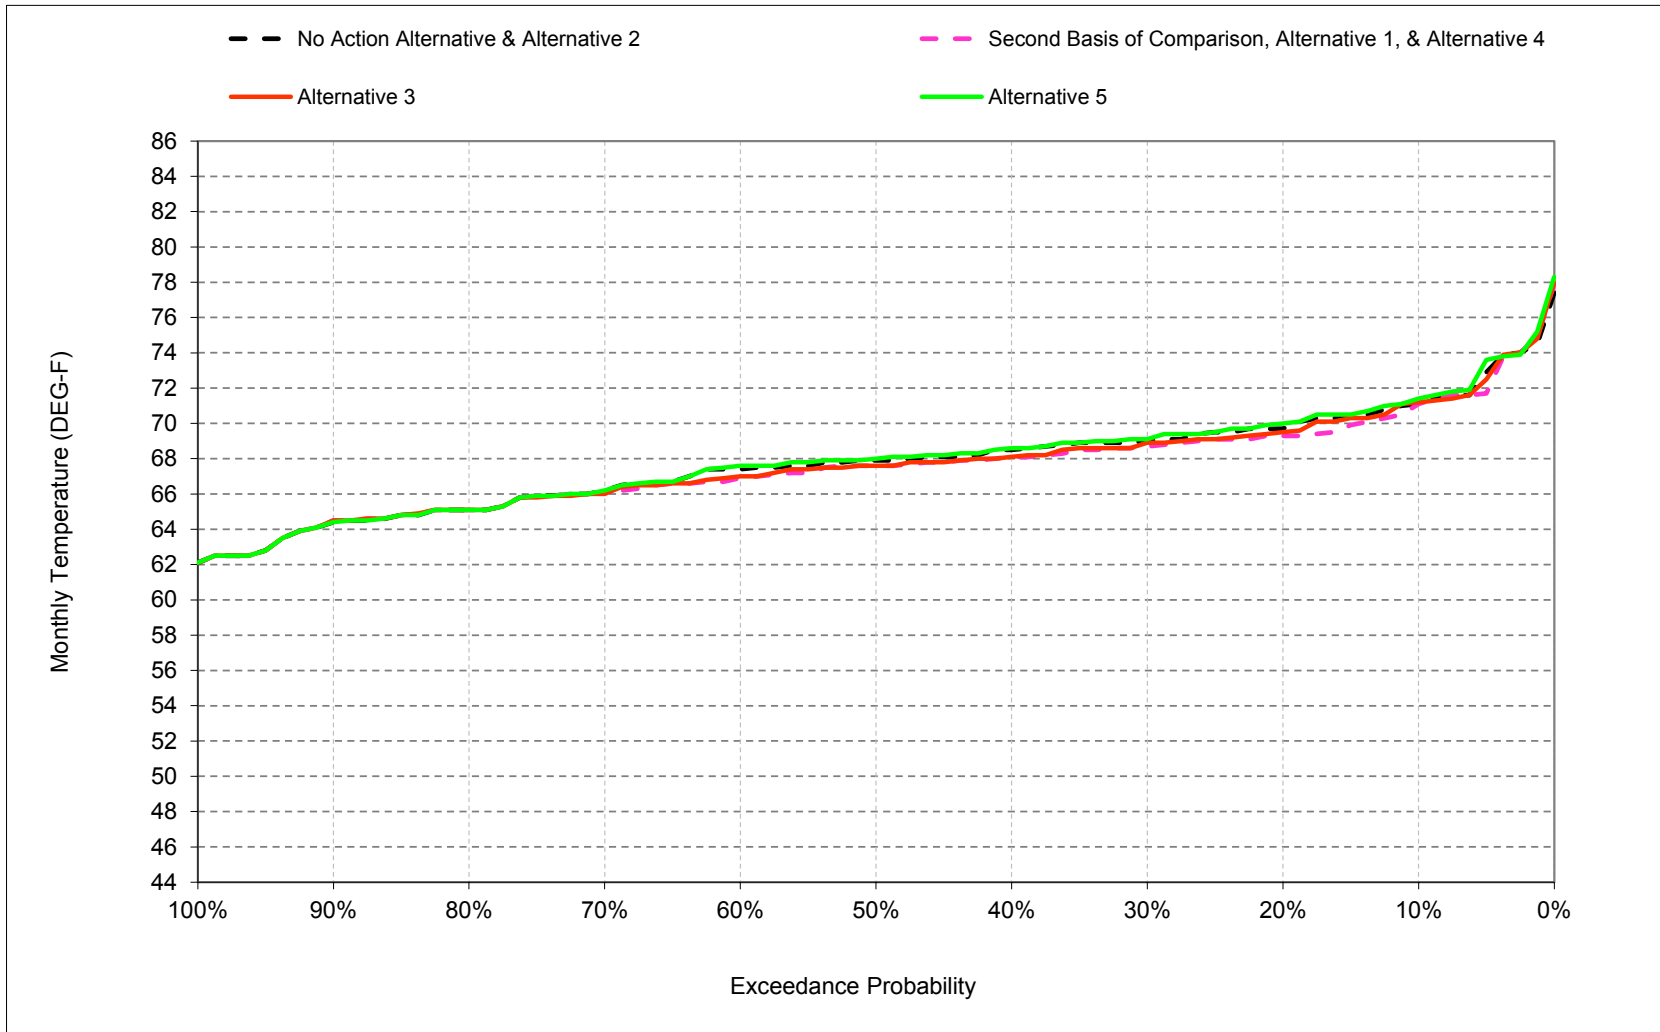


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-23-9. Feather River at Mouth, June

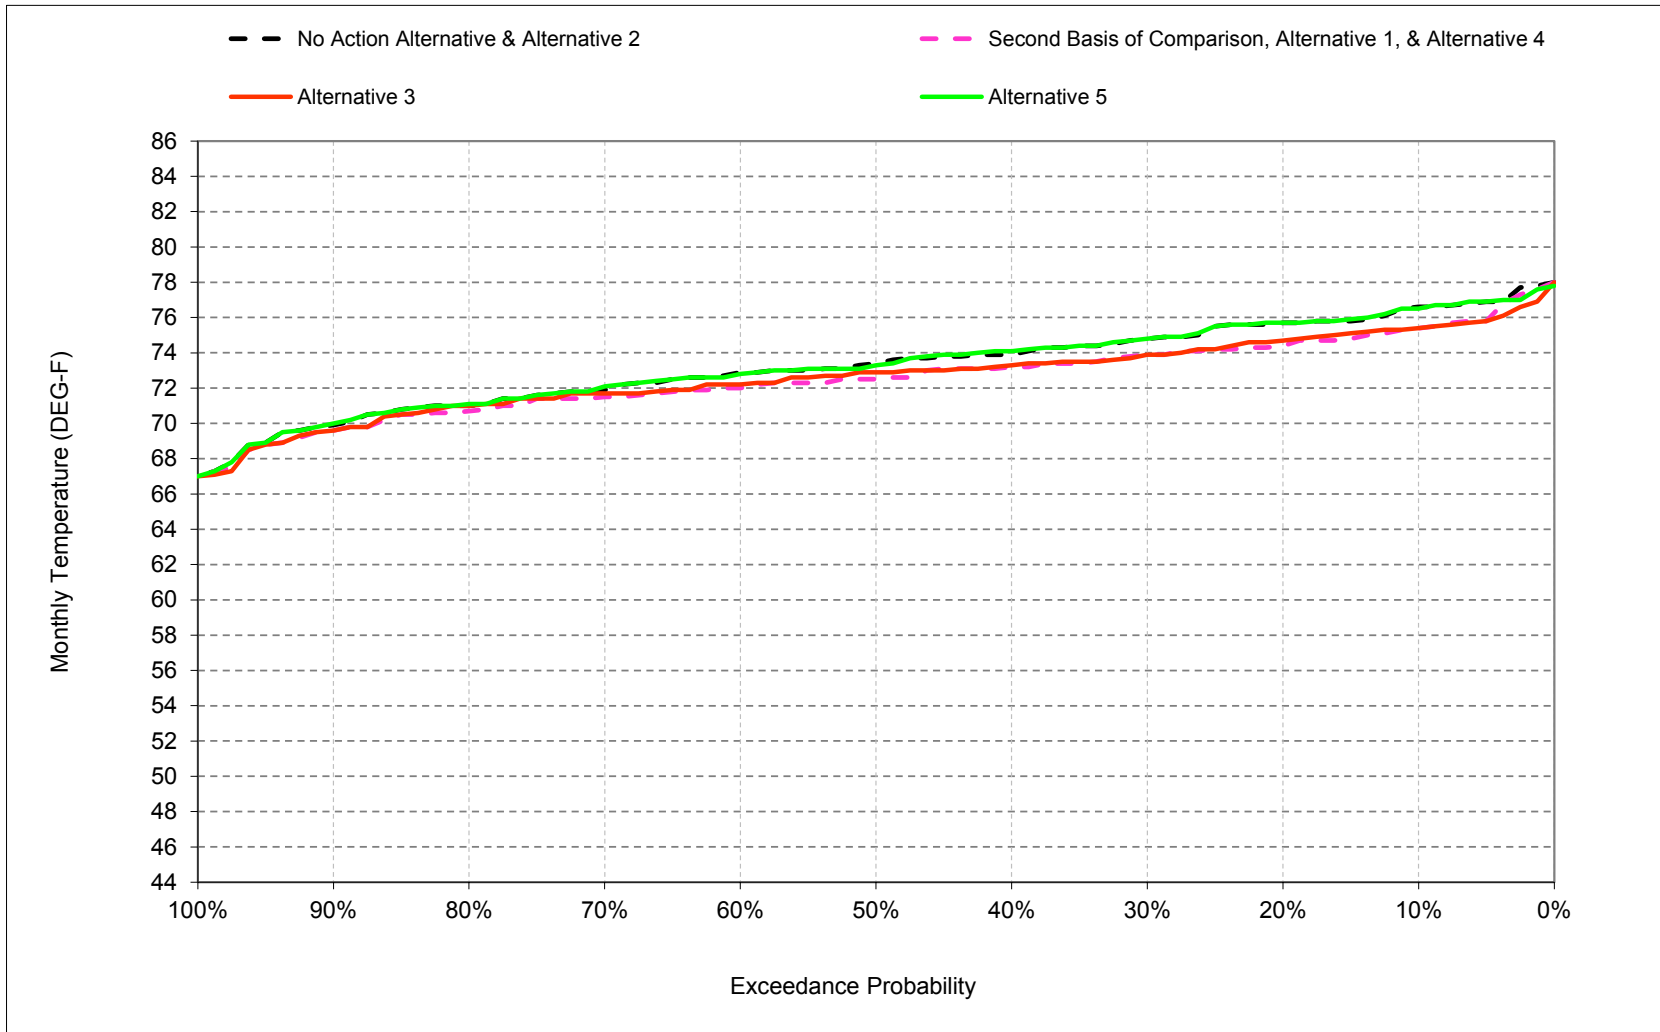


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-23-10. Feather River at Mouth, July

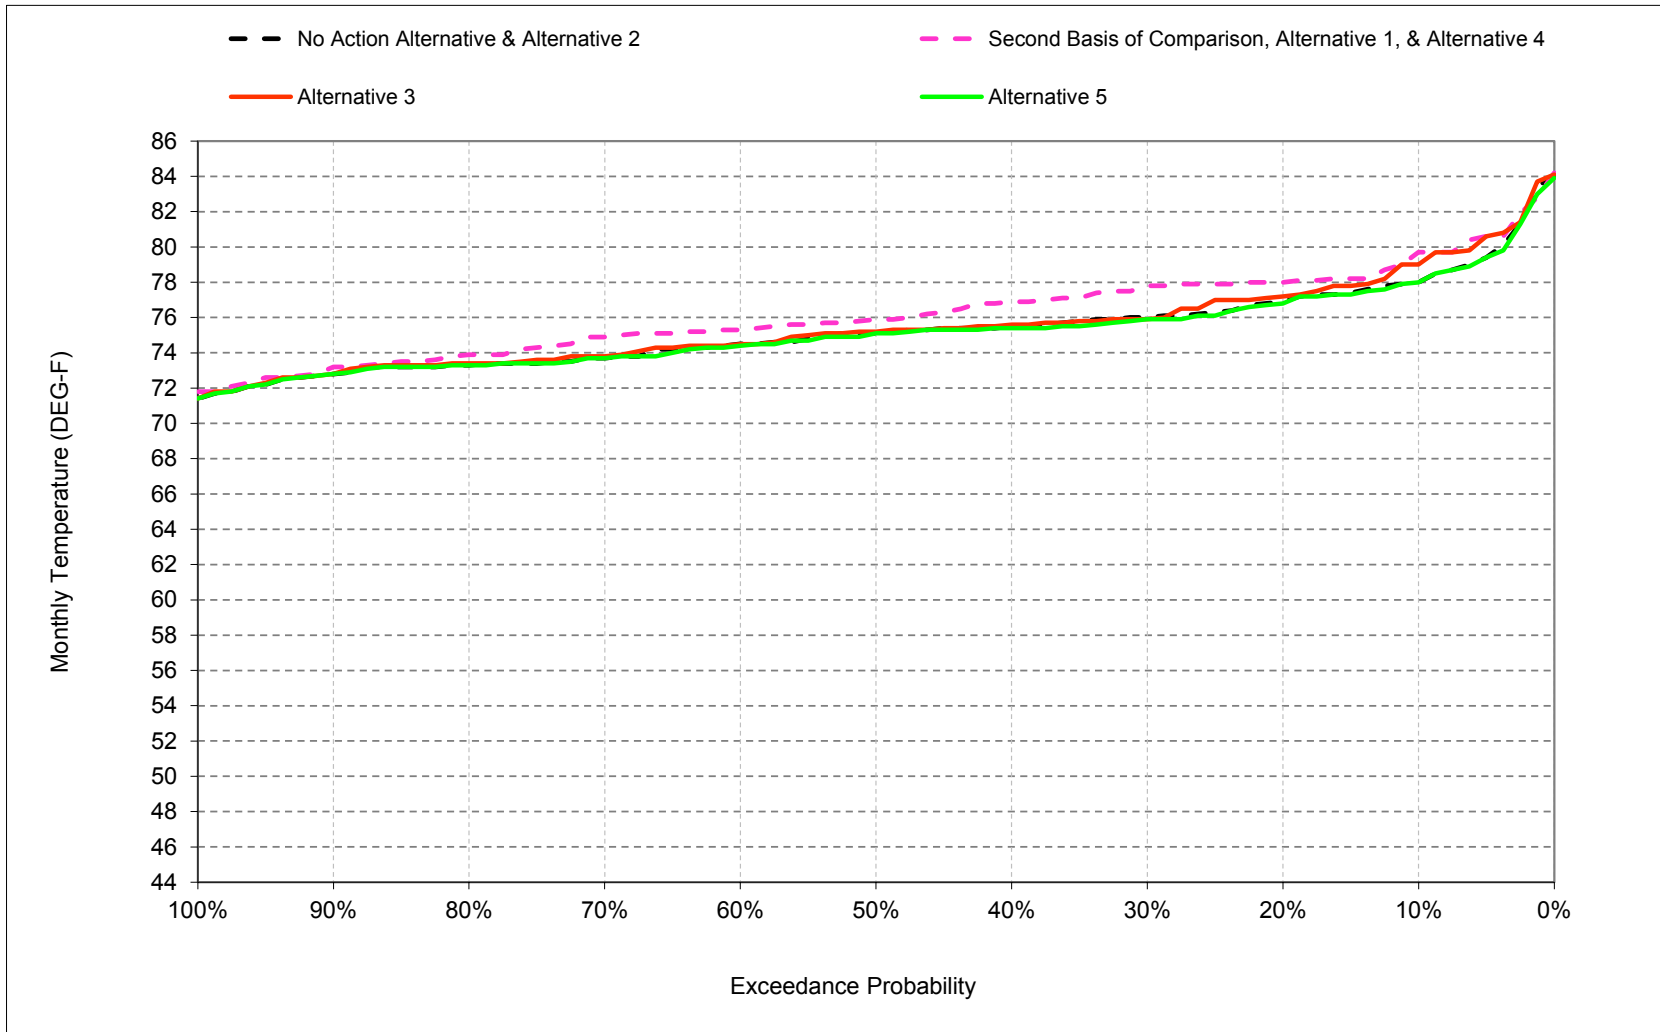


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-23-11. Feather River at Mouth, August

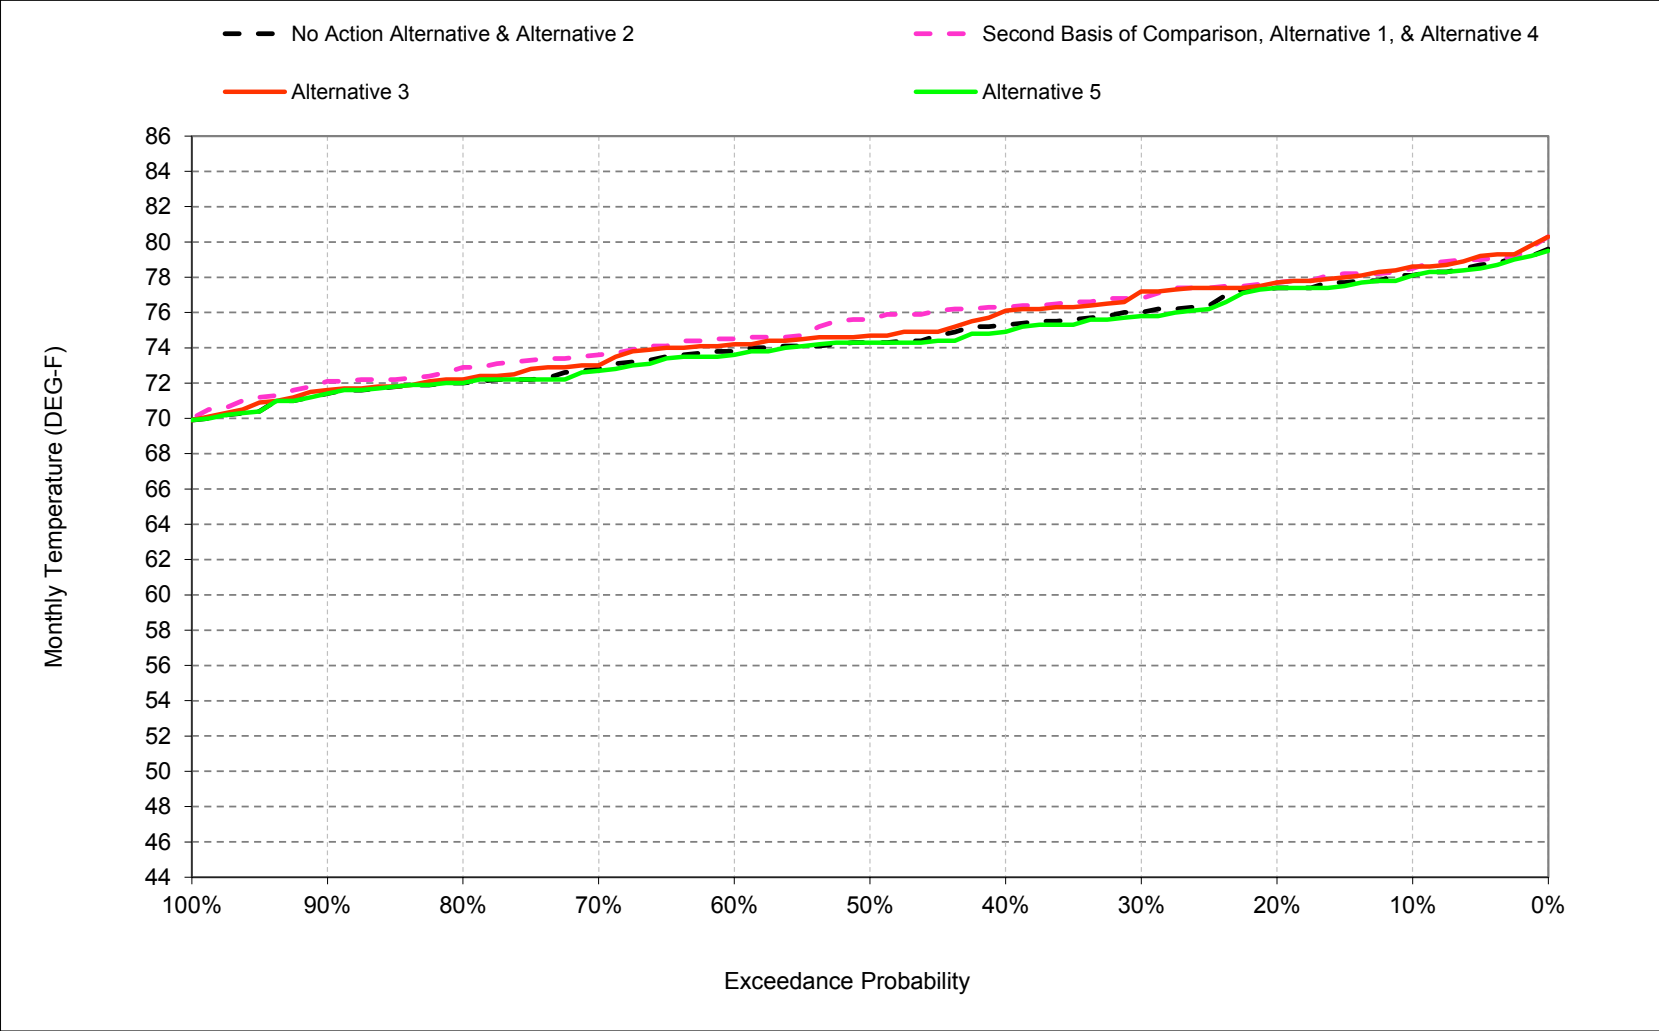

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure B-23-12. Feather River at Mouth, September

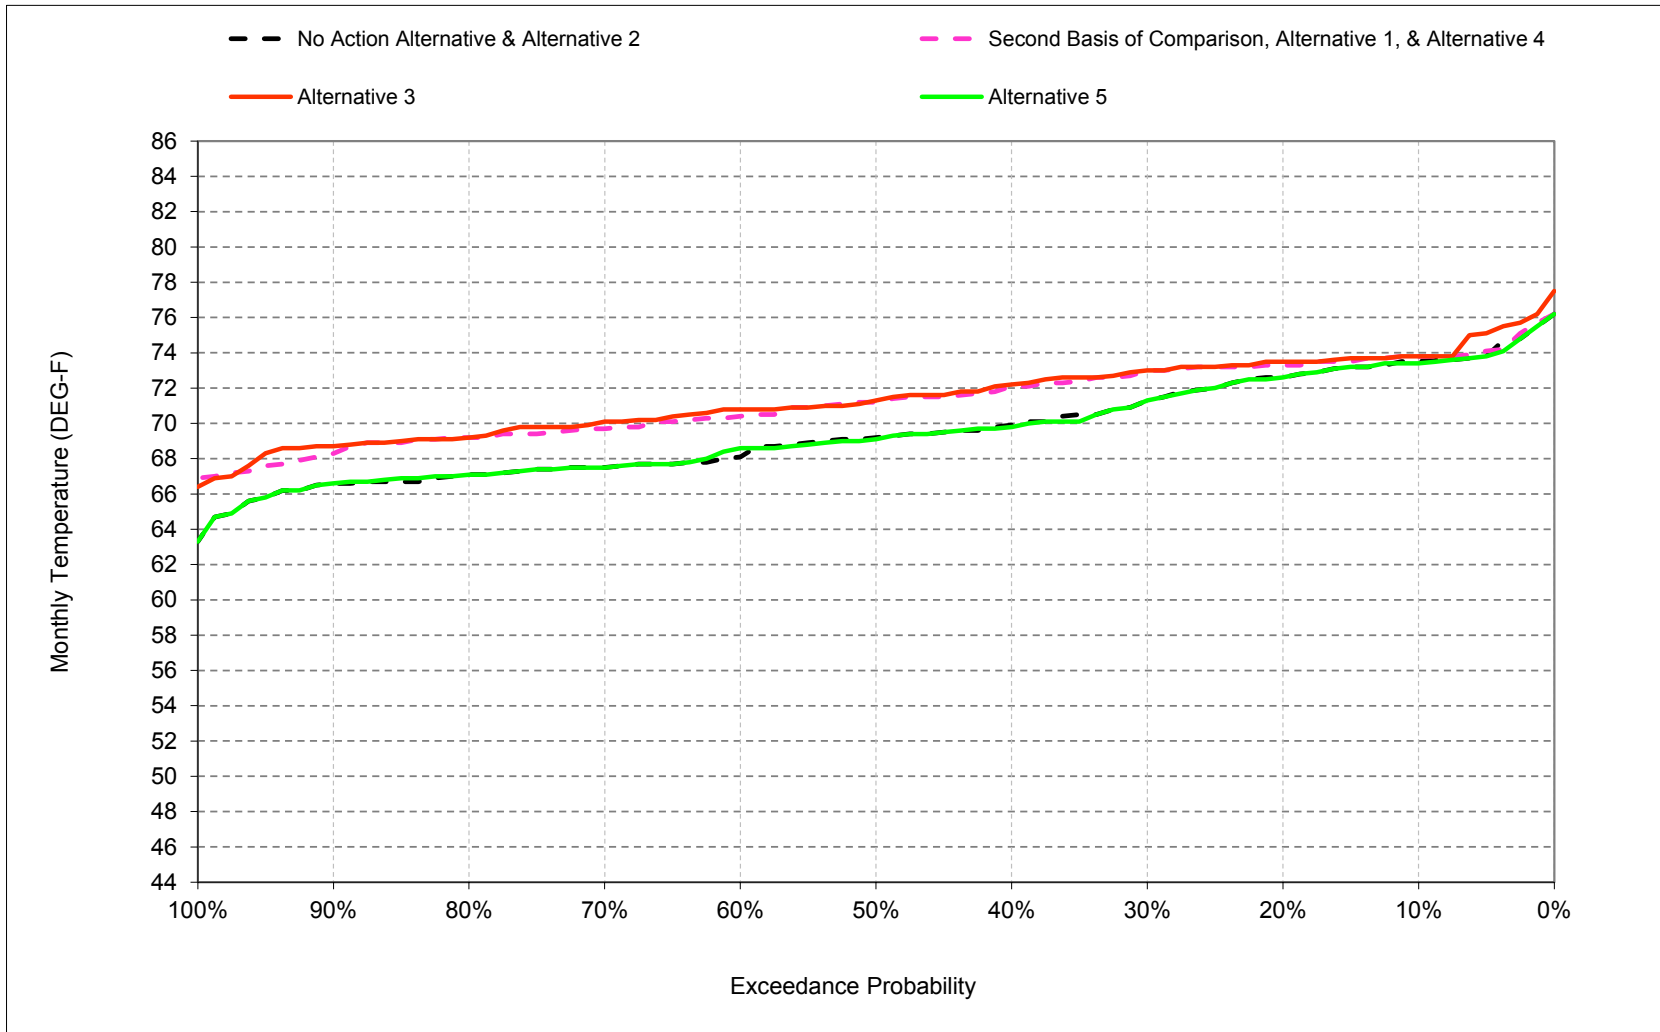

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-23-1. Feather River at Mouth, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	65	56	50	49	53	58	66	71	77	78	78	74
20%	64	55	49	48	52	57	63	70	76	77	77	73
30%	63	55	48	48	52	56	63	69	75	76	76	71
40%	63	54	48	47	51	56	62	69	74	76	75	70
50%	62	54	48	47	51	55	61	68	73	75	74	69
60%	62	53	47	46	51	55	61	67	73	75	74	68
70%	61	53	47	46	50	54	60	66	72	74	73	68
80%	60	53	46	45	50	54	58	65	71	73	72	67
90%	60	52	45	45	49	53	58	64	70	73	71	67
Long Term												
Full Simulation Period ^b	62	54	47	47	51	55	61	68	73	75	75	70
Water Year Types^c												
Wet (32%)	59	51	46	47	51	54	59	66	72	75	74	68
Above Normal (16%)	62	54	48	44	47	51	57	63	68	68	66	62
Below Normal (13%)	62	53	48	47	51	56	63	68	74	74	74	71
Dry (24%)	62	54	47	46	51	56	62	69	74	75	76	71
Critical (15%)	64	54	46	46	52	57	64	69	74	79	78	72

Alternative 1												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	65	56	50	49	53	58	66	71	75	80	79	74
20%	64	55	49	48	52	57	64	69	74	78	78	73
30%	63	54	48	48	52	56	63	69	74	78	77	73
40%	63	54	48	48	51	56	62	68	73	77	76	72
50%	62	54	47	47	51	55	61	68	73	76	76	71
60%	61	53	47	46	51	55	61	67	72	75	75	70
70%	61	53	47	46	50	54	60	66	72	75	74	70
80%	60	52	46	45	50	54	58	65	71	74	73	69
90%	60	52	45	45	49	53	58	65	70	73	72	68
Long Term												
Full Simulation Period ^b	62	54	47	47	51	55	61	68	73	76	75	71
Water Year Types^c												
Wet (32%)	59	51	46	47	51	54	59	66	71	75	75	72
Above Normal (16%)	62	54	48	44	47	51	57	62	67	68	67	64
Below Normal (13%)	62	53	47	47	51	56	62	67	72	75	75	71
Dry (24%)	62	54	47	46	51	56	62	69	74	77	76	71
Critical (15%)	63	55	46	46	52	57	64	69	74	79	78	72

Alternative 1 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
0.1	-0.2	0.0	0.0	0.0	0.0	-0.1	0.0	0.0	-1.2	1.7	0.4	0.3
0.2	-0.1	-0.1	0.1	0.0	0.0	0.0	0.1	-0.4	-1.3	1.1	0.3	0.7
0.3	0.2	-0.2	0.0	0.1	0.0	-0.2	0.0	-0.3	-0.9	1.8	0.8	1.7
0.4	0.0	-0.3	-0.1	0.1	0.0	0.0	0.0	-0.4	-0.7	1.4	1.0	2.2
0.5	-0.2	-0.2	-0.1	0.0	0.0	0.0	0.0	-0.3	-0.9	0.8	1.3	2.0
0.6	-0.2	-0.2	-0.3	0.0	0.0	-0.1	0.1	-0.5	-0.9	0.8	0.7	2.3
0.7	-0.4	-0.1	-0.1	0.0	0.0	0.0	0.0	-0.1	-0.4	1.2	0.8	2.2
0.8	-0.3	-0.3	-0.1	0.0	0.0	-0.2	0.0	0.0	-0.3	0.6	0.9	2.1
0.9	0.1	-0.1	0.3	0.0	-0.1	-0.1	0.0	0.1	-0.3	0.4	0.7	1.7
Long Term												
Full Simulation Period ^b	-0.2	-0.1	-0.1	0.1	0.0	-0.1	0.0	-0.2	-0.7	0.9	0.7	1.6
Water Year Types^c												
Wet (32%)	-0.1	-0.2	0.1	0.1	0.0	0.0	0.0	0.0	-0.2	0.6	1.2	4.0
Above Normal (16%)	-0.1	-0.1	-0.4	0.0	0.0	-0.1	0.0	-0.3	-0.9	0.5	0.8	2.1
Below Normal (13%)	-0.1	-0.3	-0.6	0.0	0.1	-0.1	-0.1	-0.8	-2.0	0.9	1.5	0.2
Dry (24%)	-0.1	-0.1	-0.2	0.0	0.0	0.0	0.0	-0.3	-0.6	1.6	0.0	-0.1
Critical (15%)	-0.5	0.3	0.1	0.0	-0.1	0.0	-0.1	0.0	-0.5	0.6	0.0	-0.1

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on an 81-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-23-2. Feather River at Mouth, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	65	56	50	49	53	58	66	71	77	78	78	74
20%	64	55	49	48	52	57	63	70	76	77	77	73
30%	63	55	48	48	52	56	63	69	75	76	76	71
40%	63	54	48	47	51	56	62	69	74	76	75	70
50%	62	54	48	47	51	55	61	68	73	75	74	69
60%	62	53	47	46	51	55	61	67	73	75	74	68
70%	61	53	47	46	50	54	60	66	72	74	73	68
80%	60	53	46	45	50	54	58	65	71	73	72	67
90%	60	52	45	45	49	53	58	64	70	73	71	67
Long Term												
Full Simulation Period ^b	62	54	47	47	51	55	61	68	73	75	75	70
Water Year Types ^c												
Wet (32%)	59	51	46	47	51	54	59	66	72	75	74	68
Above Normal (16%)	62	54	48	44	47	51	57	63	68	68	66	62
Below Normal (13%)	62	53	48	47	51	56	63	68	74	74	74	71
Dry (24%)	62	54	47	46	51	56	62	69	74	75	76	71
Critical (15%)	64	54	46	46	52	57	64	69	74	79	78	72

Alternative 3												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	65	55	49	49	53	58	65	71	75	79	79	74
20%	64	55	49	48	52	57	63	70	75	77	78	74
30%	63	54	48	48	52	56	63	69	74	76	77	73
40%	63	54	48	47	51	56	62	68	73	76	76	72
50%	62	54	48	47	51	55	61	68	73	75	75	71
60%	61	53	47	47	51	55	61	67	72	75	74	71
70%	61	53	47	46	50	54	60	66	72	74	73	70
80%	60	52	46	45	50	54	58	65	71	73	72	69
90%	60	52	45	45	49	53	58	65	70	73	72	69
Long Term												
Full Simulation Period ^b	62	54	47	47	51	55	61	68	73	76	75	71
Water Year Types ^c												
Wet (32%)	59	51	46	47	51	54	59	66	71	75	75	72
Above Normal (16%)	62	54	48	44	47	51	57	62	67	68	67	64
Below Normal (13%)	62	53	47	47	51	56	62	68	73	74	73	71
Dry (24%)	62	54	47	46	51	56	62	69	74	76	76	72
Critical (15%)	63	54	46	46	52	57	64	69	74	79	78	72

Alternative 3 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.0	-0.3	-0.2	0.0	0.0	-0.1	-0.3	0.1	-1.2	1.0	0.5	0.3
0.2	0.1	-0.1	0.0	0.0	0.0	-0.1	0.0	-0.2	-1.0	0.3	0.3	0.9
0.3	0.2	-0.3	-0.1	0.1	0.0	-0.1	0.0	-0.1	-0.9	-0.1	1.2	1.7
0.4	-0.1	-0.4	-0.1	0.0	0.0	-0.1	0.0	-0.4	-0.6	0.1	0.8	2.3
0.5	-0.1	-0.3	0.0	0.0	0.0	0.0	0.0	-0.3	-0.5	0.1	0.4	2.1
0.6	-0.2	-0.3	-0.2	0.1	0.0	0.0	0.0	-0.4	-0.7	0.0	0.4	2.7
0.7	0.1	-0.1	-0.1	0.0	0.0	0.0	0.0	-0.2	-0.2	0.1	0.2	2.6
0.8	-0.1	-0.3	-0.1	0.0	0.0	-0.1	0.0	0.0	0.0	0.1	0.2	2.1
0.9	0.2	-0.2	0.3	0.0	-0.1	-0.1	0.0	0.1	-0.3	0.0	0.2	2.1
Long Term												
Full Simulation Period ^b	0.0	-0.2	-0.1	0.0	0.0	0.0	0.0	-0.2	-0.6	0.2	0.4	1.8
Water Year Types ^c												
Wet (32%)	0.0	-0.2	0.1	0.1	0.0	0.0	0.0	0.0	-0.4	0.2	1.0	4.4
Above Normal (16%)	-0.1	-0.2	-0.3	0.0	0.0	0.0	0.0	-0.3	-0.5	0.0	0.4	2.1
Below Normal (13%)	0.1	-0.3	-0.6	0.0	0.1	0.0	-0.1	-0.4	-0.8	-0.3	-0.2	0.5
Dry (24%)	0.2	-0.2	-0.2	0.0	0.0	-0.1	0.0	-0.2	-0.8	0.5	0.3	0.1
Critical (15%)	-0.2	0.0	0.2	0.0	0.0	-0.1	0.0	0.0	-0.7	0.3	0.0	0.0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on an 81-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-23-3. Feather River at Mouth, Monthly Temperature

No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	65	56	50	49	53	58	66	71	77	78	78	74
20%	64	55	49	48	52	57	63	70	76	77	77	73
30%	63	55	48	48	52	56	63	69	75	76	76	71
40%	63	54	48	47	51	56	62	69	74	76	75	70
50%	62	54	48	47	51	55	61	68	73	75	74	69
60%	62	53	47	46	51	55	61	67	73	75	74	68
70%	61	53	47	46	50	54	60	66	72	74	73	68
80%	60	53	46	45	50	54	58	65	71	73	72	67
90%	60	52	45	45	49	53	58	64	70	73	71	67
Long Term												
Full Simulation Period ^b	62	54	47	47	51	55	61	68	73	75	75	70
Water Year Types ^c												
Wet (32%)	59	51	46	47	51	54	59	66	72	75	74	68
Above Normal (16%)	62	54	48	44	47	51	57	63	68	68	66	62
Below Normal (13%)	62	53	48	47	51	56	63	68	74	74	74	71
Dry (24%)	62	54	47	46	51	56	62	69	74	75	76	71
Critical (15%)	64	54	46	46	52	57	64	69	74	79	78	72

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	65	56	50	49	53	58	66	71	77	78	78	73
20%	64	55	49	48	52	57	63	70	76	77	77	73
30%	63	55	48	48	52	56	63	69	75	76	76	71
40%	63	54	48	47	51	56	62	69	74	75	75	70
50%	62	54	48	47	51	55	61	68	73	75	74	69
60%	62	53	47	46	51	55	61	68	73	74	74	69
70%	61	53	47	46	50	54	60	66	72	74	73	68
80%	60	53	46	45	50	54	58	65	71	73	72	67
90%	60	52	45	45	49	53	58	64	70	73	71	67
Long Term												
Full Simulation Period ^b	62	54	47	47	51	55	61	68	73	75	74	70
Water Year Types ^c												
Wet (32%)	59	51	46	47	51	54	59	66	72	75	74	68
Above Normal (16%)	62	54	48	44	47	51	57	63	68	68	66	62
Below Normal (13%)	62	53	48	47	51	56	63	68	74	74	73	70
Dry (24%)	62	54	47	46	51	56	62	70	74	75	75	71
Critical (15%)	64	54	46	46	52	57	64	69	74	79	77	72

Alternative 5 minus No Action Alternative												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3	-0.1	0.0	0.0	-0.1
0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3	0.0	-0.1	0.0	0.0
0.3	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	-0.1	-0.2	0.0
0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.2	-0.1	-0.4	-0.1
0.5	0.0	-0.1	0.1	0.0	0.0	0.0	0.0	0.1	-0.1	0.0	0.0	-0.1
0.6	0.1	0.0	-0.1	0.0	0.0	0.0	0.0	0.2	-0.1	-0.1	-0.2	0.5
0.7	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.0	-0.1	0.0
0.8	-0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0
0.9	0.0	0.0	0.8	0.0	0.0	-0.1	0.0	0.0	0.1	0.0	0.0	0.0
Long Term												
Full Simulation Period ^b	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	-0.1	-0.1	0.0
Water Year Types ^c												
Wet (32%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.1
Above Normal (16%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Below Normal (13%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	-0.2	-0.1
Dry (24%)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3	0.0	-0.2	-0.1	0.0
Critical (15%)	0.0	0.0	0.3	0.0	0.0	0.0	0.0	0.1	0.0	-0.1	-0.2	-0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-23-4. Feather River at Mouth, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	65	56	50	49	53	58	66	71	75	80	79	74
20%	64	55	49	48	52	57	64	69	74	78	78	73
30%	63	54	48	48	52	56	63	69	74	78	77	73
40%	63	54	48	48	51	56	62	68	73	77	76	72
50%	62	54	47	47	51	55	61	68	73	76	76	71
60%	61	53	47	46	51	55	61	67	72	75	75	70
70%	61	53	47	46	50	54	60	66	72	75	74	70
80%	60	52	46	45	50	54	58	65	71	74	73	69
90%	60	52	45	45	49	53	58	65	70	73	72	68
Long Term												
Full Simulation Period ^b	62	54	47	47	51	55	61	68	73	76	75	71
Water Year Types ^c												
Wet (32%)	59	51	46	47	51	54	59	66	71	75	75	72
Above Normal (16%)	62	54	48	44	47	51	57	62	67	68	67	64
Below Normal (13%)	62	53	47	47	51	56	62	67	72	75	75	71
Dry (24%)	62	54	47	46	51	56	62	69	74	77	76	71
Critical (15%)	63	55	46	46	52	57	64	69	74	79	78	72

No Action Alternative

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	65	56	50	49	53	58	66	71	77	78	78	74
20%	64	55	49	48	52	57	63	70	76	77	77	73
30%	63	55	48	48	52	56	63	69	75	76	76	71
40%	63	54	48	47	51	56	62	69	74	76	75	70
50%	62	54	48	47	51	55	61	68	73	75	74	69
60%	62	53	47	46	51	55	61	67	73	75	74	68
70%	61	53	47	46	50	54	60	66	72	74	73	68
80%	60	53	46	45	50	54	58	65	71	73	72	67
90%	60	52	45	45	49	53	58	64	70	73	71	67
Long Term												
Full Simulation Period ^b	62	54	47	47	51	55	61	68	73	75	75	70
Water Year Types ^c												
Wet (32%)	59	51	46	47	51	54	59	66	72	75	74	68
Above Normal (16%)	62	54	48	44	47	51	57	63	68	68	66	62
Below Normal (13%)	62	53	48	47	51	56	63	68	74	74	74	71
Dry (24%)	62	54	47	46	51	56	62	69	74	75	76	71
Critical (15%)	64	54	46	46	52	57	64	69	74	79	78	72

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.2	0.0	0.0	0.0	0.0	0.1	0.0	0.0	1.2	-1.7	-0.4	-0.3
0.2	0.1	0.1	-0.1	0.0	0.0	0.0	-0.1	0.4	1.3	-1.1	-0.3	-0.7
0.3	-0.2	0.2	0.0	-0.1	0.0	0.2	0.0	0.3	0.9	-1.8	-0.8	-1.7
0.4	0.0	0.3	0.1	-0.1	0.0	0.0	0.0	0.4	0.7	-1.4	-1.0	-2.2
0.5	0.2	0.2	0.1	0.0	0.0	0.0	0.0	0.3	0.9	-0.8	-1.3	-2.0
0.6	0.2	0.2	0.3	0.0	0.0	0.1	-0.1	0.5	0.9	-0.8	-0.7	-2.3
0.7	0.4	0.1	0.1	0.0	0.0	0.0	0.0	0.1	0.4	-1.2	-0.8	-2.2
0.8	0.3	0.3	0.1	0.0	0.0	0.2	0.0	0.0	0.3	-0.6	-0.9	-2.1
0.9	-0.1	0.1	-0.3	0.0	0.1	0.1	0.0	-0.1	0.3	-0.4	-0.7	-1.7
Long Term												
Full Simulation Period ^b	0.2	0.1	0.1	-0.1	0.0	0.1	0.0	0.2	0.7	-0.9	-0.7	-1.6
Water Year Types ^c												
Wet (32%)	0.1	0.2	-0.1	-0.1	0.0	0.0	0.0	0.0	0.2	-0.6	-1.2	-4.0
Above Normal (16%)	0.1	0.1	0.4	0.0	0.0	0.1	0.0	0.3	0.9	-0.5	-0.8	-2.1
Below Normal (13%)	0.1	0.3	0.6	0.0	-0.1	0.1	0.1	0.8	2.0	-0.9	-1.5	-0.2
Dry (24%)	0.1	0.1	0.2	0.0	0.0	0.0	0.0	0.3	0.6	-1.6	0.0	0.1
Critical (15%)	0.5	-0.3	-0.1	0.0	0.1	0.0	0.1	0.0	0.5	-0.6	0.0	0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-23-5. Feather River at Mouth, Monthly Temperature

Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	65	56	50	49	53	58	66	71	75	80	79	74
20%	64	55	49	48	52	57	64	69	74	78	78	73
30%	63	54	48	48	52	56	63	69	74	78	77	73
40%	63	54	48	48	51	56	62	68	73	77	76	72
50%	62	54	47	47	51	55	61	68	73	76	76	71
60%	61	53	47	46	51	55	61	67	72	75	75	70
70%	61	53	47	46	50	54	60	66	72	75	74	70
80%	60	52	46	45	50	54	58	65	71	74	73	69
90%	60	52	45	45	49	53	58	65	70	73	72	68
Long Term												
Full Simulation Period ^b	62	54	47	47	51	55	61	68	73	76	75	71
Water Year Types ^c												
Wet (32%)	59	51	46	47	51	54	59	66	71	75	75	72
Above Normal (16%)	62	54	48	44	47	51	57	62	67	68	67	64
Below Normal (13%)	62	53	47	47	51	56	62	67	72	75	75	71
Dry (24%)	62	54	47	46	51	56	62	69	74	77	76	71
Critical (15%)	63	55	46	46	52	57	64	69	74	79	78	72

Alternative 3

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	65	55	49	49	53	58	65	71	75	79	79	74
20%	64	55	49	48	52	57	63	70	75	77	78	74
30%	63	54	48	48	52	56	63	69	74	76	77	73
40%	63	54	48	47	51	56	62	68	73	76	76	72
50%	62	54	48	47	51	55	61	68	73	75	75	71
60%	61	53	47	47	51	55	61	67	72	75	74	71
70%	61	53	47	46	50	54	60	66	72	74	73	70
80%	60	52	46	45	50	54	58	65	71	73	72	69
90%	60	52	45	45	49	53	58	65	70	73	72	69
Long Term												
Full Simulation Period ^b	62	54	47	47	51	55	61	68	73	76	75	71
Water Year Types ^c												
Wet (32%)	59	51	46	47	51	54	59	66	71	75	75	72
Above Normal (16%)	62	54	48	44	47	51	57	62	67	68	67	64
Below Normal (13%)	62	53	47	47	51	56	62	68	73	74	73	71
Dry (24%)	62	54	47	46	51	56	62	69	74	76	76	72
Critical (15%)	63	54	46	46	52	57	64	69	74	79	78	72

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.2	-0.3	-0.2	0.0	0.0	0.0	-0.3	0.1	0.0	-0.7	0.1	0.0
0.2	0.2	0.0	-0.1	0.0	0.0	-0.1	-0.1	0.2	0.3	-0.8	0.0	0.2
0.3	0.0	-0.1	-0.1	0.0	0.0	0.1	0.0	0.2	0.0	-1.9	0.4	0.0
0.4	-0.1	-0.1	0.0	-0.1	0.0	-0.1	0.0	0.0	0.1	-1.3	-0.2	0.1
0.5	0.1	-0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.4	-0.7	-0.9	0.1
0.6	0.0	-0.1	0.1	0.1	0.0	0.1	-0.1	0.1	0.2	-0.8	-0.3	0.4
0.7	0.5	0.0	0.0	0.0	0.0	0.0	0.0	-0.1	0.2	-1.1	-0.6	0.4
0.8	0.2	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.3	-0.5	-0.7	0.0
0.9	0.1	-0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.4	-0.5	0.4
Long Term												
Full Simulation Period ^b	0.2	-0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.1	-0.7	-0.3	0.2
Water Year Types ^c												
Wet (32%)	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	-0.2	-0.5	-0.2	0.4
Above Normal (16%)	0.0	-0.1	0.1	0.0	0.0	0.1	0.0	0.0	0.4	-0.4	-0.5	-0.1
Below Normal (13%)	0.1	0.0	0.0	0.0	0.0	0.0	-0.1	0.4	1.1	-1.1	-1.7	0.3
Dry (24%)	0.3	-0.1	-0.1	0.0	0.0	0.0	0.0	0.1	-0.2	-1.1	0.3	0.2
Critical (15%)	0.3	-0.3	0.1	0.0	0.1	0.0	0.0	0.0	-0.2	-0.3	0.0	0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table B-23-6. Feather River at Mouth, Monthly Temperature

Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	65	56	50	49	53	58	66	71	75	80	79	74
20%	64	55	49	48	52	57	64	69	74	78	78	73
30%	63	54	48	48	52	56	63	69	74	78	77	73
40%	63	54	48	48	51	56	62	68	73	77	76	72
50%	62	54	47	47	51	55	61	68	73	76	76	71
60%	61	53	47	46	51	55	61	67	72	75	75	70
70%	61	53	47	46	50	54	60	66	72	75	74	70
80%	60	52	46	45	50	54	58	65	71	74	73	69
90%	60	52	45	45	49	53	58	65	70	73	72	68
Long Term												
Full Simulation Period ^b	62	54	47	47	51	55	61	68	73	76	75	71
Water Year Types ^c												
Wet (32%)	59	51	46	47	51	54	59	66	71	75	75	72
Above Normal (16%)	62	54	48	44	47	51	57	62	67	68	67	64
Below Normal (13%)	62	53	47	47	51	56	62	67	72	75	75	71
Dry (24%)	62	54	47	46	51	56	62	69	74	77	76	71
Critical (15%)	63	55	46	46	52	57	64	69	74	79	78	72

Alternative 5												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	65	56	50	49	53	58	66	71	77	78	78	73
20%	64	55	49	48	52	57	63	70	76	77	77	73
30%	63	55	48	48	52	56	63	69	75	76	76	71
40%	63	54	48	47	51	56	62	69	74	75	75	70
50%	62	54	48	47	51	55	61	68	73	75	74	69
60%	62	53	47	46	51	55	61	68	73	74	74	69
70%	61	53	47	46	50	54	60	66	72	74	73	68
80%	60	53	46	45	50	54	58	65	71	73	72	67
90%	60	52	45	45	49	53	58	64	70	73	71	67
Long Term												
Full Simulation Period ^b	62	54	47	47	51	55	61	68	73	75	74	70
Water Year Types ^c												
Wet (32%)	59	51	46	47	51	54	59	66	72	75	74	68
Above Normal (16%)	62	54	48	44	47	51	57	63	68	68	66	62
Below Normal (13%)	62	53	48	47	51	56	63	68	74	74	73	70
Dry (24%)	62	54	47	46	51	56	62	70	74	75	75	71
Critical (15%)	64	54	46	46	52	57	64	69	74	79	77	72

Alternative 5 minus Second Basis of Comparison												
Statistic	Monthly Temperature (DEG-F)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
0.1	0.2	0.0	0.0	0.0	0.0	0.1	0.0	0.3	1.1	-1.7	-0.4	-0.4
0.2	0.1	0.1	-0.1	0.0	0.0	0.0	-0.1	0.7	1.3	-1.2	-0.3	-0.7
0.3	-0.1	0.3	0.0	-0.1	0.0	0.2	0.0	0.4	0.9	-1.9	-1.0	-1.7
0.4	0.0	0.3	0.1	-0.1	0.0	0.0	0.0	0.5	0.9	-1.5	-1.4	-2.3
0.5	0.2	0.1	0.2	0.0	0.0	0.0	0.0	0.4	0.8	-0.8	-1.3	-2.1
0.6	0.3	0.2	0.2	0.0	0.0	0.1	-0.1	0.7	0.8	-0.9	-0.9	-1.8
0.7	0.5	0.1	0.1	0.0	0.0	0.0	0.0	0.1	0.6	-1.2	-0.9	-2.2
0.8	0.2	0.4	0.1	0.0	0.0	0.2	0.0	0.0	0.4	-0.6	-0.9	-2.1
0.9	-0.1	0.1	0.5	0.0	0.1	0.0	0.0	-0.1	0.4	-0.4	-0.7	-1.7
Long Term												
Full Simulation Period ^b	0.2	0.1	0.2	0.0	0.0	0.1	0.0	0.3	0.7	-1.0	-0.8	-1.6
Water Year Types ^c												
Wet (32%)	0.1	0.3	-0.1	-0.1	0.0	0.0	0.0	0.0	0.2	-0.7	-1.3	-3.9
Above Normal (16%)	0.1	0.1	0.4	0.0	0.0	0.1	0.0	0.3	0.9	-0.5	-0.8	-2.1
Below Normal (13%)	0.1	0.2	0.6	0.0	-0.1	0.1	0.1	1.0	2.0	-0.9	-1.7	-0.3
Dry (24%)	0.1	0.0	0.2	0.0	0.0	0.0	0.0	0.6	0.6	-1.8	-0.1	0.0
Critical (15%)	0.5	-0.3	0.2	0.0	0.1	0.1	0.1	0.1	0.4	-0.7	-0.2	0.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on an 81-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1 **Appendix 6B, Section C**

2 **Surface Water Temperature Modeling –**
3 **HEC-5Q Model Update**

4 Information about the methods and assumptions used for the Coordinated Long-
5 Term Operation of the Central Valley Project (CVP) and State Water Project
6 (SWP) Environmental Impact Statement (EIS) analysis on surface water
7 temperature is provided in this appendix. This appendix is organized into three
8 sections that are briefly described below:

- 9 • Appendix 6B, Section A: Surface Water Temperature Modeling Methodology,
10 Simulations, and Assumptions
- 11 – The water quality impacts analysis uses the HEC-5Q and Reclamation
12 Monthly Temperature models to assess and quantify effects of the
13 alternatives on the environment. This section provides information about
14 the overall analytical framework linkages with other models.
- 15 – This section provides a brief description of the assumptions for the surface
16 water temperature model simulations of the No Action Alternative,
17 Second Basis of Comparison, and other alternatives.
- 18 • Appendix 6B, Section B: Surface Water Temperature Modeling Results
- 19 – This section provides model outputs and a description of the model
20 simulation output formats used in the analysis and interpretation of
21 modeling results for the alternatives impacts assessment.
- 22 • Appendix 6B, Section C: HEC-5Q Model Update for Surface Water
23 Temperature Modeling
- 24 – This section provides a detailed description of the compilation and updates
25 of the HEC-5Q models performed during development of the EIS for the
26 Trinity-Sacramento, American, and Stanislaus Rivers.

27 **6B.C.1 Introduction**

28 This section describes tasks that were undertaken to update the Trinity-
29 Sacramento River, American River, and San Joaquin River HEC-5Q models. The
30 work performed was for the Bureau of Reclamation (Reclamation). Four tasks
31 were performed as part of this update:

- 32 • A housekeeping task where all existing work prior to the updates was
33 compiled, organized, and modified to create a base version from which all
34 future work would be based from.
- 35 • A validation task where the Trinity-Sacramento and American River models
36 were modified to better match observed data.

- 1 • A flow mapping task where improvements to the input flows coming from
2 CalSim II were made where necessary.
 - 3 • A temperature targeting and selective withdrawal task where the logic used to
4 define temperature targets major reservoirs operate as well as the withdrawal
5 logic used to meet those targets was refined.
- 6 The following sections in this appendix describe the background for the model
7 updates, the five tasks, and the quality assurance/quality control (QA/QC) process
8 used to ensure the quality of the work.

9 **6B.C.2 Background**

10 In January and February of 2014, there were three separate HEC-5Q modeling
11 toolkits for Trinity-Sacramento, American, and San Joaquin River systems
12 specifically for the EIS and based on CalSim II inputs. These toolkits were
13 developed from models that Don Smith of Resource Management Associates
14 (RMA) had delivered to Reclamation previously. Various issues began to arise
15 with the model output results that resulted in a need to update the model files for
16 several projects. This produced project-specific model versions that were
17 different from the model versions delivered by RMA. After new issues continued
18 to arise, it became apparent that there was a need to implement additional logic to
19 the HEC-5Q model as well as provide organization and documentation for the
20 models.

21 **6B.C.3 Housekeeping Task**

22 This section describes the Housekeeping Task, during which the initial work of
23 compiling the Toolkit took place.

24 The goal of the Housekeeping Task was to lay out, structure, and compile an
25 initial temperature model toolkit (Toolkit) that would serve to organize all of the
26 existing work for the San Joaquin River, Trinity-Sacramento River, and American
27 River HEC-5Q models as well provide improvements necessary to create a
28 foundation for future improvements to the temperature models. The
29 Housekeeping Task consisted of deciding on the contents of the Toolkit; laying
30 out its structure; and compiling its contents, testing, improvements, and
31 documentation.

32 The Housekeeping Task first identified the contents of the Toolkit and how it
33 would be structured. It was recommended that there be one central HEC-5Q
34 Toolkit that would contain an individual folder for the San Joaquin River, the
35 Trinity-Sacramento Rivers, and the American River models. Within each river
36 folder, there would be a complete application model (files, data, protocol
37 document, and QA/QC tools) based on CalSim II inputs and that could support
38 climate change scenarios. The river folders would also contain a complete
39 calibration model from which the application model was developed. The Toolkit

1 would support running the model through a batch process, which is the process
 2 through which the previous toolkits were run, as well as through the graphical
 3 user interface (GUI). Both the batch process and the GUI would utilize the same
 4 model files in order to eliminate redundant files. The models would run on the
 5 same executables, contained in a folder separate from the river folders (labeled
 6 bin). There would also be a folder for the GUI, which would include all the files
 7 required to run the GUI and a protocol document. There would also be a central
 8 reference document library and a version control folder that would track the
 9 source and changes of all the files contained within the Toolkit over the course of
 10 the updates.

11 The reference document library is a compilation of documents that were deemed
 12 necessary or useful as references for the user of the Toolkit. Included with the
 13 reference document library was the development of an HEC-5Q Quick Start
 14 Guide that was requested by Reclamation as part of the updates. This quick start
 15 guide provides an overview of how the all the model components work.

16 The file structure was designed to be compatible with either the use of the Batch
 17 Process or the GUI to run the models and to be consistent with the file structure
 18 used for the modeling for EIS. Ideally, the use of the GUI would fit within this
 19 structure. However, after some investigation into how the GUI locates the
 20 required input files, it was determined that using the GUI within the file structure
 21 and using only one set of model files for both the Batch Process and the GUI
 22 would require code changes to the GUI itself. Therefore, a decision was made to
 23 not fully implement the GUI into the Toolkit but to include it anyway.

24 After identifying the contents of the Toolkit and laying out the structure, the next
 25 task was to compile the contents. This involved reconciling different versions of
 26 the model files. Table 6B.C.1 shows the model versions that were reconciled for
 27 each river.

28 **Table 6B.C.1 HEC-5Q Model Toolkits Reconciled during the Housekeeping Task**

River	Models	Toolkits
Trinity-Sacramento	SRWQM** Extension (October 2013)	Remand_SRWQM_Toolkit (January 24, 2014)
San Joaquin	CDFW* SJR Model (June 2013)	Remand_SJR_HEC5Q_Toolkit (February 21, 2014)
American	SRWQM Extension (October 2013)	Remand_FAST_HEC5Q_Toolkit (February 18, 2014)

- 29 a. California Department of Fish and Wildlife
 30 b. Sacramento River Water Quality Model

31 There were substantial differences between the versions of the Trinity-
 32 Sacramento River model. The SRWQM model (January 2014) was originally
 33 developed in 2002 and modeled only the Trinity River (to below Lewiston Dam)
 34 and the Sacramento River (to below Knights Landing). The SRWQM Extension
 35 (October 2013) extended the SRWQM model to include the Feather River (from
 36 Oroville Reservoir), the American River (from Folsom Reservoir), the Sutter

1 Bypass, and the lower Sacramento River (to below Freeport). The SRWQM
2 Extension included new meteorological data that the Feather and American River
3 extensions of the model were calibrated to. However, the older Trinity-
4 Sacramento River section of the model was not recalibrated to the new
5 meteorological data.

6 During compilation of the Toolkit, it was recommended that the Trinity and
7 Sacramento River sections of the SRWQM Extension be the versions used
8 moving forward. Those sections represented the latest modeling logic and nodal
9 layout, including the Sutter Bypass. However, changes had to be made to the
10 SRWQM Extension files before it could be incorporated. First, the Feather River
11 was removed completely from the model files, as well as the lower Sacramento
12 River (from the Feather River confluence to below Freeport) because it receives
13 inputs from the Feather River. Second, a validation procedure was undertaken to
14 adjust the necessary model parameters in order to incorporate the updated Gerber
15 California Irrigation Management Information System (CIMIS) station
16 meteorological data. A detailed description of this validation procedure is
17 described below.

18 The San Joaquin River and American River versions were mostly consistent
19 between the versions. Changes had been made on the Stanislaus River primarily
20 for consistency with CalSim II. During the Housekeeping Task, an increase in the
21 Tulloch power plant outflow capacity was implemented in the Toolkit. It should
22 be noted that the previous versions of the San Joaquin River model included
23 Electrical Conductivity as an additional output parameter of the model. This
24 capability was removed for the Toolkit.

25 The American River version had a spreadsheet that computed downstream
26 temperature targets for Folsom Outflow and Watt Avenue and two file changes
27 for consistency with CalSim II. The spreadsheet and file changes were included
28 in the Toolkit. During the Housekeeping Task, implementation of the Folsom
29 Water Supply Intake Temperature Control Device (Folsom TCD) was included.
30 Implementing the logic for the Folsom TCD required a validation run of the
31 American River, which is described in detail below.

32 Compilation of the Toolkit into the agreed upon file structure included the need to
33 change the reconciled files. These changes included changing path names in the
34 batch files and renaming files so that there was a consistent naming convention
35 across the three different river models. Also, among the changes was the
36 implementation of common executables for the CalSim II pre-processor and
37 HEC-5Q for each of the three models. This would eliminate redundant files and
38 make changes to the CalSim II pre-processor and HEC-5Q codes easier, as code
39 changes would only occur in one file. Also among the changes was the
40 implementation of common executables for the CalSim II pre-processor and
41 HEC-5Q.

42 In addition to the elements required for the models, model files and data from
43 previous work that were part of the development of the models were compiled.
44 These included the 2002 Sacramento River calibration (RMA 2003), the 2013

1 American River calibration (RMA 2013), the 2013 Stanislaus River calibration,
2 and the Sacramento River and American River validations described below.

3 **6B.C.4 Validation**

4 This section describes the validation procedures and required updates to the
5 model for the Trinity-Sacramento and American River models.

6 **6B.C.4.1 Trinity-Sacramento River**

7 The Trinity-Sacramento River model was originally developed and calibrated in
8 2002, using meteorological data from the Gerber CIMIS station (RMA 2003).
9 Since that 2002 calibration, the model code has changed and there are updated
10 meteorological data from the Gerber CIMIS station. During the Housekeeping
11 Task, it was recommended that the Trinity-Sacramento River model incorporate
12 the updated meteorological data from the Gerber CIMIS station. Fully
13 incorporating the updated Gerber meteorological data would require a full
14 recalibration of the model, which was beyond the scope of this project. Instead, a
15 validation task was conducted to produce temperature results similar to the 2002
16 calibration. The validation task assumed the following conditions:

- 17 • 1981-2002 hydrology from the 2002 calibration
- 18 • Ambient temperature data that were used in 2002
- 19 • Revised meteorology developed in 2012
- 20 • Control point configuration consistent with CalSim II
- 21 • Bypasses included in the model representation

22 During the validation process, equilibrium temperature scaling factors for the
23 reservoirs, reaches, reservoir inflows, and tributary inflows were adjusted to
24 match observed data. The scaling factors were adjusted to compensate for higher
25 equilibrium temperatures of the updated Gerber meteorology data. The
26 equilibrium temperatures of the updated Gerber meteorology were higher than the
27 2002 Gerber meteorology because the updated data were computed without a
28 wind speed scaling factor assumption, while the 2002 data had been computed
29 with an assumed wind speed scaling factor.

30 Several comparison plots and tables from select locations that are representative
31 of the computed versus observed temperature results of the Trinity-Sacramento
32 River validation are contained in Appendix 6B, Section A. Comparison plots and
33 tables at additional locations can be found in the document titled *Trinity*
34 *Sacramento River 2014 Validation Plots* included in the file set for this report. In
35 general, the validation task resulted in computed temperatures that had good
36 agreement with observed data. Table 6B.C.2 shows the average computed and
37 observed temperature at select locations in the Trinity-Sacramento River model.

1 **Table 6B.C.2 Average Computed and Observed Temperatures at Select Locations**
 2 **Resulting from the Validation of the Trinity-Sacramento River Model**

Location	Average Computed Temperature (°F)	Average Observed Temperature (°F)
Trinity River below Lewiston Dam	48.3	47.9
Sacramento River below Shasta Dam	49.8	58.6
Sacramento River below Keswick Dam	51.0	51.1
Sacramento River below Clear Creek	51.8	51.6
Sacramento River at Balls Ferry	52.7	52.7
Sacramento River at Bend Bridge	53.3	53.8
Sacramento River at Red Bluff	53.8	54.1
Sacramento River at Tehama	54.2	54.2
Sacramento River at Woodson Bridge	55.1	55.1
Sacramento River at Butte City	57.8	57.9
Sacramento River above Colusa Drain	59.4	58.8

3 **6B.C.4.2 American River**

4 The American River HEC-5Q model was developed in 2013 as part of the
 5 SRWQM Extension (RMA 2013). Subsequent to this initial development, the
 6 model shortcomings listed below were identified and addressed. Implementing
 7 the fixes required for these shortcomings required a validation of the American
 8 River HEC-5Q model data to make sure they still matched observed data.

9 **6B.C.4.2.1 Folsom Water Supply Temperature Control Device**

10 The Folsom Water Supply Intake Temperature Control Device (Folsom TCD)
 11 was not properly represented in the 2013 calibration model, resulting in
 12 withdrawal of cold water at depth. The model was modified to represent the
 13 withdrawal as a movable port that can move based on the following operating
 14 objectives and constraints:

- 15 • Minimum submergence limit of 15 feet. The negative value indicates the
 16 variable level output as opposed to a fixed port representation that was
 17 original envisioned.
- 18 • Maximum temperature constraint of 18⁰C. The outlet will be lowered to
 19 access this or a lower temperature when constrained by the minimum
 20 submergence requirement.
- 21 • Operating elevation range between 320 feet and 460 feet.

- 1 The LD record in Figure 6B.C.1 shows the change in the American River
- 2 HEC-5Q data file implemented for the Folsom TCD.

```

c.... Diversions
C field Original single port diversion
c (1) ADV Area of the diversion withdrawal port in ft2 or m2.
c (2) QLDV Fraction of the diverted flow assigned to the diversion. (TF)
c (3) ELDV Centerline elevation of diversion point in feet or meters. (TEL1)
C if TELT is negative. the TCD option is triggered

c.... TCD equiped water supply diversion (e.g., American River/Folsom Dam domestic water supply)
c (3) ELDV Minimum depth of submergence - flagged by a minus depth. (TEL1<0.)
c (4) LDT Maximum allowable temperature (C) at active outlet. (TET1)
c The selected port will be the controlling of these two constraint
c (5) DWSELDV(1) Centerline elevation of the lowest diversion point (TELP(1)) or
c -1 for moveable outlet that can access any element

c... If DWSELDV(1) = -1 (moveable outlet)
c (6) DWSELDV(2) Lowest diversion access elevation (TELP(2))
c (7) DWSELDV(2) highest diversion access elevation (TELP(3))

Current assumptions / data

c... Folsom Dam Water Supply TCD - represented as a variable level intake
c... Dec 22, 2014 ... Russ Yaworsky recommendation
c. Withdrawal target temperature between 63-65F (17.2 - 18.3C)
c. Lowest accessible level of approximately 320'
c... TCD operation rules as defined by "LD" record data:
c. minimum submergence constraint = 15'
c. maximum temperature constraint = 18C
c. Folsom Water Supply option flag = -1
c. Operating elevation range between 320 & 460
LD 135 1.0 -15.0 18.0 -1 320 460
    
```

- 3
- 4 **Figure 6B.C.1 Change in the American River HEC-5Q Data File for the Folsom**
- 5 **Water Supply Intake Temperature Control Device**

6 **6B.C.4.2.2 Folsom Inflow Temperatures**

7 Inflow temperatures were lowered relative to observed data in the 2013
 8 calibration model to compensate for the low level extraction of cold water by the
 9 fixed depth domestic water supply outlet. These inflow temperatures were
 10 increased relative to the 2013 calibration model temperatures with the
 11 implementation of the new Folsom TCD logic.

12 **6B.C.4.2.3 Folsom Evaporation**

13 A change in the L2 record (see Figure 6B.C.2) was made to account for the
 14 separation of evaporation in CalSim II. The standard version of HEC-5Q will
 15 only accommodate a single diversion; however, CalSim II reports evaporation as
 16 a flow equivalent rate (E8) which is represented as a surface diversion in HEC-5Q
 17 while the Folsom Lake domestic water supply diversion (D8) is diverted at depth.
 18 Therefore, these two rates cannot be combined for accurate temperature
 19 simulation. From a flow accounting perspective (HEC5), the total flow diverted
 20 from the lake is E8+D8. By setting IQDEV = 2, the evaporation component of
 21 total diversion is defined as a DSS path using the ZR Record and subtracted from
 22 E8+D8 in HEC-5Q.

1	c.	Reservoir evaporation using CALSIMII operation data
2	c.	HEC5Q can accommodate only one diversion. CALSIM reports evaporation as a flow equivalent
3	c.	rate which is represented as a surface diversion in HEC5Q.
4	c.	Folsom also has a domestic water supply that is diverted at depth, therefore it cannot
5	c.	be combined with evaporation. By setting IQDEV = 2, the evaporation component of
6	c.	total diversion is defined as a DSS path using the 2R Record.
7	c.	FK2R FK2C FK2S SFMET1 SFMET2 sfmt3 IQDEV
8	L2	1 1 1 0.5 0.90 1.10 2
9	2R	EV590 A=American B=Folsom Lake C=flow-evap E=1DAY F=2020D09E-1

1

2 **Figure 6B.C.2 Change in the American River HEC-5Q Data File to Separate**
 3 **Evaporation from Total Diversion at Folsom Dam**

4 **6B.C.4.2.4 River Mile Correction**

5 The river mile location of Nimbus and Folsom Dams were improperly defined in
 6 the 2013 calibration model. A half-mile reach was inserted below Nimbus Dam
 7 to match the river mile locations of Nimbus and Folsom Dams in the HEC-RAS
 8 model. The Nimbus Dam went from river mile 22 to 22.5 and Folsom Dam went
 9 from river mile 28.7 to 29.2. This change affects temperature results.

10 In general, the validation resulted in good agreement between computed and
 11 observed temperatures. The average computed and observed temperatures at
 12 select locations in the American River model are shown in Table 6B.C.3.

13 **Table 6B.C.3 Average Computed and Observed Temperatures at Select Locations**
 14 **Resulting from the Validation of the Trinity-Sacramento River Model**

Location	Average Computed Temperature (°F)	Average Observed Temperature (°F)
American River below Nimbus Dam	56.5	56.7
American River at William Pond Park	57.7	57.7
American River at Watt Avenue	58.5	58.3

15 **6B.C.5 Flow/Boundary Condition Mapping**

16 HEC-5Q receives flow inputs from CalSim II through the CalSim II_HEC-5Q
 17 pre-processing executable. Monthly CalSim II flow and storage time series
 18 outputs are read into the executable where they are combined and mapped to
 19 nodes in the HEC-5Q model based on specifications in the [River model]_CS.dat
 20 (e.g. SR_CS.dat) file, converted to daily time series, and stored in the HEC-5Q
 21 input DSS file (CalSim II_HEC5Q.DSS). In the case of the storage time series, a
 22 daily patterning procedure is applied. As part of the temperature model updates,
 23 several modifications were made to improve the flow mapping of CalSim II to
 24 HEC-5Q. Additionally, HEC-5Q provides flow and temperature inputs to several
 25 fisheries models. These modifications are described below.


26 **6B.C.5.1 Sutter Bypass Boundary Conditions Mapping**

27 During modifications of the SRWQM Extension model files for the
 28 Trinity-Sacramento River model, it was determined that there was some incorrect

1 mapping with the CalSim II schematic at Butte Creek. Specifically, there was
 2 double-counting of the Butte Creek Inflow at the Knights Landing control point.
 3 In CalSim II, Butte Creek inflow is input into the Sutter Bypass. However, in the
 4 SRWQM Extension, that inflow was added directly into the Sacramento River,
 5 causing higher flows in the Sacramento River at Knights Landing in the HEC-5Q
 6 model as compared to CalSim II. The Butte City inflow record (specifically
 7 IN118 in the SR_CS.dat file) was removed in the SR_5CS.dat file for the final
 8 Trinity-Sacramento River model.

9 **6B.C.5.2 American River Flow Mapping Change**

10 The control point resolution below Nimbus Dam was inadequate in the 2013
 11 calibration model to properly allocate the City of Sacramento withdrawal. This
 12 lack of resolution presented a problem in relating HEC-5Q flows to CalSim II
 13 flows. The additional control point that localizes the City of Sacramento
 14 withdrawal is shown on Figure 6B.C.3. The additional control point (CP) #572
 15 results in the depletions / accretions being distributed uniformly between CP 572
 16 and CP 578 (mile 7.5 to mile 22.0). The City of Sacramento diversion is applied
 17 at CP 570. This change only has a small impact on temperature (it reduces
 18 temperatures at Watt Avenue up to +/- 0.5°F).

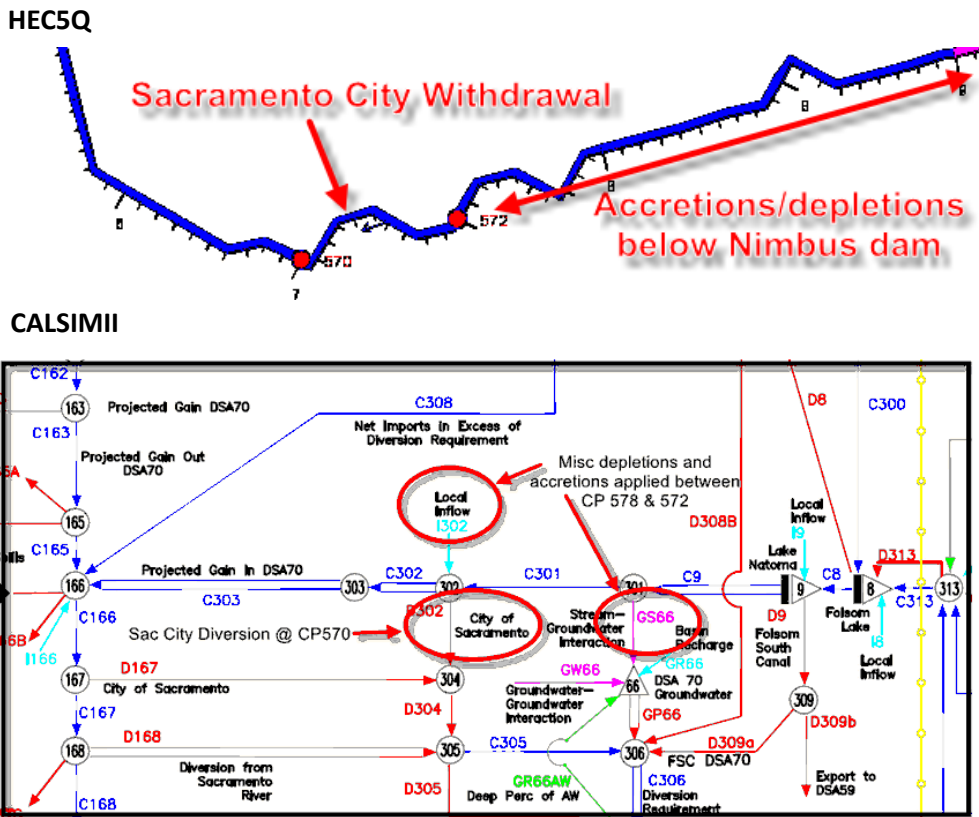

19
 20 **Figure 6B.C.3 Schematics of HEC-5Q and CalSim II Models with Additional Control**
 21 **Point 572**

1 **6B.C.5.3 Stanislaus River**

2 The flow mapping between CalSim II and HEC-5Q in the Delta-Mendota Canal
3 section of the San Joaquin River model is currently inadequate and results in
4 serious flow differences. To fully address this requires a modification to the
5 CalSim II schematic, which is beyond the scope of the work to update the
6 temperature models. Since the EIS only focuses on temperature effects from
7 Reclamation operations on the Stanislaus and Lower San Joaquin Rivers, the San
8 Joaquin River model was reduced to only include the Stanislaus River and the San
9 Joaquin River from the Stanislaus River confluence to the head of Old River. A
10 requirement of this model to run and simulate temperatures at Vernalis was to
11 develop a boundary condition time series of inflow temperature at the San Joaquin
12 River above the Stanislaus River confluence. This time series would incorporate
13 all the upstream temperature effects due to water operations above this point in
14 the San Joaquin River basin (including Friant, Mendota Pool, and the Tuolumne
15 and Merced Rivers). This time series was generated with the February 21, 2014
16 San Joaquin River HEC-5Q model using the EIS No Action Alternative Q5
17 CalSim II results for inputs.

18 **6B.C.5.4 Mapping to Fisheries Models**

19 The capability of mapping HEC-5Q flow and temperature outputs with three
20 fisheries models was added to the Sacramento River model, including SALMOD,
21 Reclamation Mortality model, and Cramer Fish Sciences models.

22 **6B.C.6 Temperature Target, Selective Withdrawal,
23 and Operational Outputs**

24 This section describes the temperature targeting and/or selective withdrawal
25 changes and procedures for the Trinity, Shasta, and Folsom Dams. These changes
26 were completed after the validation was deemed appropriate because the
27 temperature targets do not affect the matching of the observed temperatures; the
28 validation period of record occurred when the Trinity Dam auxiliary outlet and
29 Folsom Dam low-level outlets were not used.

30 **6B.C.6.1 Trinity River**

31 **6B.C.6.1.1 Seasonal Temperature Target Schedule**

32 A simplistic approach for seasonal temperature targets was implemented for the
33 Trinity River. The seasonal targets are shown in Table 6B.C.4. The temperature
34 targets of importance are the 49⁰F temperatures between August and November
35 when temperature management is the most crucial on the Trinity River and the
36 auxiliary outlet (described in the next section) is allowed to operate. The 60⁰F
37 temperature target was implemented to force power generation in the model.

1 **Table 6B.C.4 Seasonal Temperature Targets for Trinity Dam to Operate to in the**
 2 **HEC-5Q Model**

Date	Temperature Target
January 1	60 ⁰ F
July 31	60 ⁰ F
August 15	49 ⁰ F
November 30	49 ⁰ F
December 1	60 ⁰ F
December 31	60 ⁰ F

3 Trinity Dam has a low-level (auxiliary) outlet, a morning glory spillway, and a
 4 single-level power intake that doubles as a high capacity river outlet. The
 5 relevant input data for Trinity Dam in the Trinity-Sacramento HEC-5Q data file
 6 are shown on Figure 6B.C.4. (Note that the line numbers are for reference only
 7 and are not line numbers in the Trinity-Sacramento HEC5Q data file.) Additional
 8 diagrams that were used as the basis for the improvements to Trinity Dam
 9 selective withdrawal logic in the Trinity-Sacramento River model are included in
 10 later portions of this appendix.

```

1 c... Trinity Dam power bypass operation is based on Dec 22 conference call, two Figures #2
2 c. flow versus head plots and recent turbine retrofit plots. (references?)
3 c... History
4 c. Power bypass for temperature control (access cold water pool) occurred in 2009 and 2014
5 c. Turbines were upgraded to increase capacity and efficiency during the past few years
6 c... Operating rules for power bypass:
7 c. The low level (Auxiliary) outlet is either open or closed with an outlet capacity computed
8 c. as a function of Lake elevation (approximately 2,000 cfs at typical Lake levels)
9 c. Temperature compliance assumes a blend of power production to maintain minimum flow below the Dam
10 c. and the Auxiliary open for a sufficient time to pass the bypass flow.
11 c. (i.e., daily average flow through the Auxiliary outlet determines the hours of operation)
12 c. Outlet data record definition:
13 c. L5 = Auxiliary Outlet (power bypass)
14 c. L7 = Power/River Outlet
15 c. L6 = Morning Glory Spillway
16 c... Dimensions / elevation based on Figure 2 invert elevations and tunnel diameter
17 c... Invert/crest Elev Diameter Centerline / Crest Elev (assumed)
18 c L5 1995.5 7' 2000
19 c L7 2100.0 20' 2110
20 c L6 2370.0 54' 2370
21 c. Bypass power to achieve temperature compliance is based on targets defined by PT records
22 c. (i.e., summer/fall temperature objective = 47 Fahrenheit)
23 c. The first 72 columns of the L5 Record are standard HEC5Q data
24 c. Data beyond column 72 provide the following power bypass constraints
25 c. Maximum and minimum fraction of flow through the Auxiliary outlet | | |
26 c. Maximum flow through the Auxiliary outlet (e.g., 12 hrs at 2,000 = 1,000) | | |
27 c. Calendar date limits for Power bypass to low level outlet | | |
28 c. area Max Q Elev
29 L5 100 2000 2000 .67 .16 1000. 15-Aug 30-Nov
30 c. Standard HEC5Q input for spillway (L6) and power/river outlet (L7)
31 L6 54 12000 2370
32 L7 400 7800 2110
33 c. The flow limits on the L5 and L7 Records are place holders to meet model requirements
34 c. The actual outlet capacities are computed in the Trinity specific code section of HEC5Q
35 c. as a function of watersurface elevation. These relationships are described in
36 c. "HEC-5Q Water Temperature Model, Sacramento River System" The power generation outflow
37 c. and the river outlet flow share the same outlet conduit, therefore, there is no distinction
38 c. between the generation flow and release of excess flow to the River from a temperature
39 c. perspective. (The Auxiliary outlet is approximately 100' lower than the power/river outlet)
40 c. The outlet operation summary file reports the maximum power potential for information only
41 c. The following Record names the outlet summary file and implements the power bypass operation.
42 c. note that the character string "USBR opp:" is interchangeable with "SAVE opp:"
43 USBR opp: Trinity_Power_Bypass.txt
44 c. Temperature targets control the seasonal limits for power bypass
45 c. (subject to the calendar day constraints on the L5 Record)
46 c. A high target temperature will preclude power bypass operation
47 c. The calendar date input format assumes temperature units of degrees Fahrenheit
48 PT 1/01 60.0 7/31 60.0 8/15 47.0 11/30 47.0
49 PT 12/01 60.0 12/31 60.0

```

1

2 **Figure 6B.C.4 Input Data Relevant to the Trinity Dam Selective Withdrawal**
3 **Procedure in the Trinity-Sacramento HEC-5Q Data File**

4 As the auxiliary outlet and power intake are at a fixed elevation, the only
5 available temperature control option is to bypass power generation and divert
6 colder temperature flows to the auxiliary outlet. The allocation between the
7 auxiliary (power bypass) and power flows is designed to meet the seasonal
8 temperature targets described earlier based on the Trinity-specific data described
9 below.

10 The Line 29 (L5) defines the auxiliary outlet characteristics and serves as the
11 power bypass outlet. The first 72 columns are standard inputs while the
12 additional data beyond column 72 constrain operation rules for power bypass to
13 the auxiliary outlet. The constraints imply that the auxiliary outlet can be
14 throttled to a specified flow rate. In reality, the auxiliary outlet is fully open or
15 completely closed. Therefore, the fraction of the total outflow translates to a time
16 period when the auxiliary outlet is fully open. Power flows would provide the
17 minimum flow requirement for the river above Lewiston Lake. Mixing within
18 Lewiston Lake is assumed to blend the flows of different temperatures.

- 1 • Col 73-80: Maximum fraction of the total out flow allowed through the
2 auxiliary outlet (power bypass)
- 3 • Col 81-88: Minimum fraction of the total outflow required for bypass through
4 the auxiliary outlet
- 5 • Col 89-96: Maximum flow through the auxiliary outlet in cubic feet per
6 second (cfs)
- 7 • Col 97-112: Calendar date limits for power bypass to the low-level outlet.
8 These dates override the limits set by the “PT” record.

9 Lines 31 and 32 (L6 and L7) are standard inputs defining the spillway crest length
10 and power intake area as well as the flow capacity and elevation. The maximum
11 flow for both the auxiliary (L5) and power intake (L7) serve as placeholder data.
12 The actual flow rates are defined within the code as a function of lake elevation.
13 When the flow and elevation conditions fall within the constraints seen in
14 Figure 6B.C.3, the generation flow is added to the river outlet capacity seen in
15 Figure 6B.C.2. From a temperature simulation perspective, there is no difference
16 between power flow and river release flows as they share the same outlet conduit.
17 The power production only adds to the total flow capacity of the common outlet
18 tunnel.

19 **6B.C.6.1.2 Trinity Dam Operations Output**

20 A single comma-delimited output file is generated by the Trinity Dam-specific
21 option. This file is named on the “USBR_OPP ” record that triggers the power
22 bypass option. This comma-delimited file (“Trinity Power Bypass.txt”) when
23 imported into Excel produces a file that summarizes the outlet operation and other
24 pertinent data. The file includes daily lake storage and elevation, flow capacity
25 and allocation to the auxiliary and power outlets, total outflow (release), target
26 and outflow temperature, and spill information. The screen capture shown in
27 Figure 6B.C.5 is an example of the resulting Excel file. There are two flags that
28 indicate constraints on the bypass flow. In the example, August 28 is the day that
29 is constrained by the maximum daily flow limit.

Appendix 6B.C: Surface Water Temperature Modeling – HEC-5Q Model Update

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O
1	Trinity Outlet Operation Log														
2	Units are cfs unless noted														
3	* Minimum Auxiliary outlet flow limitation														
4	*** Maximum Auxiliary outlet flow limitation														
5	Date	storage	Elevation	Auxiliary Outlet		River Outlet + power		Total	Max Power	Temperature (F)				Spill	
6		TAF	Ft	Capacity	Release	Capacity	Release	Release	capacity	Target	Outflow	Auxiliary	Power+River		
7	01-OCT-1993	1945.0	2337.1	2394	0	12126	356	356	4056	47.0	44.9	44.4	44.9	0	
8	02-OCT-1993	1944.6	2337.1	2394	0	12126	974	974	4056	47.0	44.9	44.5	44.9	0	
9	03-OCT-1993	1943.3	2337.0	2394	0	12126	330	330	4057	47.0	44.9	44.4	44.9	0	
20	10-AUG-1994	1412.5	2295.8	2245	0	11780	3044	3044	4101	50.4	47.4	45.1	47.4	0	
21	11-AUG-1994	1406.3	2295.3	2242	0	11771	2993	2993	4097	49.3	47.4	45.1	47.4	0	
22	12-AUG-1994	1399.9	2294.7	2242	0	11761	2754	2754	4093	48.4	47.4	45.1	47.4	0	
23	13-AUG-1994	1394.0	2294.2	2240	0	11752	2926	2926	4089	47.6	47.5	45.1	47.5	0	
24	14-AUG-1994	1387.9	2293.7	2236	328	11742	2628	2956	4085	47.2	47.2	45.1	47.5	0	
25	15-AUG-1994	1381.8	2293.1	2234	562	11733	2395	2957	4081	47.0	47.0	45.1	47.5	0	
26	16-AUG-1994	1375.6	2292.6	2234	602	11723	2308	2910	4076	47.0	47.0	45.1	47.5	0	
27	17-AUG-1994	1369.6	2292.0	2233	621	11714	2278	2899	4072	47.0	47.0	45.1	47.5	0	
28	18-AUG-1994	1363.6	2291.5	2230	631	11704	2216	2846	4068	47.0	47.0	45.1	47.5	0	
29	19-AUG-1994	1357.5	2291.0	2226	729	11695	2394	3123	4064	47.0	47.0	45.1	47.6	0	
30	20-AUG-1994	1350.8	2290.4	2224	736	11684	2316	3052	4059	47.0	47.0	45.2	47.6	0	
31	21-AUG-1994	1344.4	2289.8	2223	648	11674	2045	2693	4055	47.0	47.0	45.2	47.6	0	
32	22-AUG-1994	1338.4	2289.3	2220	712	11664	2034	2746	4051	47.0	47.0	45.2	47.7	0	
33	23-AUG-1994	1333.0	2288.8	2218	707	11656	1950	2657	4047	47.0	47.0	45.2	47.7	0	
34	24-AUG-1994	1327.8	2288.3	2216	749	11647	1999	2748	4043	47.0	47.0	45.2	47.7	0	
35	25-AUG-1994	1322.8	2287.8	2215	803	11639	2031	2833	4040	47.0	47.0	45.2	47.7	0	
36	26-AUG-1994	1317.4	2287.3	2213	871	11631	2128	2999	4036	47.0	47.0	45.2	47.8	0	
37	27-AUG-1994	1311.3	2286.8	2213	884	11621	2084	2968	4032	47.0	47.0	45.2	47.8	0	
38	28-AUG-1994	1304.7	2286.2	2209	1000 **	11610	2307	3307	4027	47.0	47.1	45.2	47.8	0	
39	29-AUG-1994	1298.5	2285.6	2208	959	11600	1989	2948	4023	47.0	47.0	45.2	47.9	0	
40	30-AUG-1994	1292.4	2285.0	2205	959	11590	1923	2882	4018	47.0	47.0	45.2	47.9	0	
41	31-AUG-1994	1286.4	2284.5	2205	951	11580	1875	2826	4014	47.0	47.0	45.3	47.9	0	
42	01-SEP-1994	1281.6	2284.0	2202	183	11571	373	555	4010	47.0	47.0	45.2	47.9	0	

1

2 **Figure 6B.C.5 Example Trinity Outlet Operations File Generated when Running the**
 3 **Model (The file is titled “Trinity Power Bypass.txt after the Trinity-Sacramento**
 4 **River model is run”)**

5 **6B.C.6.2 Shasta Dam**

6 **6B.C.6.2.1 Seasonal Temperature Target Schedule**

7 A Shasta Dam release temperature target scheduling spreadsheet for the Trinity-
 8 Sacramento River model was developed using logic that was derived from the
 9 National Marine Fisheries Service 2009 Biological Opinion on the Long-Term
 10 Operations of the Central Valley Project and State Water Project (NMFS BO) and
 11 actual temperature management operations provided by Reclamation. The
 12 spreadsheet generates a PT record that is referenced at line 580 in the Trinity-
 13 Sacramento HEC-5Q data file.

14 **6B.C.6.2.2 Shasta Operations Output File**

15 Two comma-delimited files (*.2xl) are produced that summarize the Shasta TCD
 16 operation. Both files provide similar information; however, the file
 17 "TCD_xx.log0.2xl" contains zeros while "TCD_xx.log.2xl" contains blanks in the
 18 computed flows and temperatures columns. The blank-filled file is easier to read
 19 but precludes arithmetic manipulation. Figure 6B.C.6 is an example Excel file
 20 generated by the “TCD_xx.log0.2xl” text file. This figure separated into two
 21 parts for ease of reading.

Appendix 6B.C: Surface Water Temperature Modeling – HEC-5Q Model Update

Columns A - U																									
A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S	T	U					
USBR Sacramento River specific Run date and time: 20MAR15 - 14:01:02																									
Date	Water Surface elevation	total release	Number of Operating Shutters				Shutter Flows - cfs				TCD Leakage (by elevation range) - cfs											Total Generation - cfs			
	- ft	cfs	top	middle	penstock	lower	top	middle	penstock	lower	Total	>1000 (Over)	1000-945	945-900	900-831	831-804	804-780	780-750	Total	(Shutter+Leakage)					
4	1-Oct-93	1012	8722.1			3	1		4798.7	2124	6922.7		198	57.6	246	59.3	1197.5	41	1799.4	8722.1					
302	26-Jul-94	1004.5	9124			3	1		4922.6	2319.1	7241.7		207.1	60.2	257.3	62	1252.7	42.9	1882.3	9124					
303	27-Jul-94	1003.9	8706.2			3	1		4793.8	2116.3	6910.1		197.6	57.5	245.5	59.2	1195.4	40.9	1796.1	8706.2					
304	28-Jul-94	1003.3	9276.4			3	1		4969.6	2393.1	7362.7		210.6	61.2	261.6	63.1	1279.6	43.6	1913.7	9276.4					
305	29-Jul-94	1002.8	8705.1			3	1		4793.5	2115.7	6909.2		197.6	57.5	245.5	59.2	1195.2	40.9	1795.9	8705.1					
306	30-Jul-94	1002.2	8873.7			3	1		4845.5	2197.6	7043.1		201.4	58.6	250.2	60.3	1216.4	41.7	1830.6	8873.7					
307	31-Jul-94	1001.6	8303.9			3	1		4050.5	2540.3	6590.7		138.5	54.8	234.2	55.5	1140.1	39	1713.1	8303.9					
308	1-Aug-94	1001.1	8353.2			3	1		4063.7	2564.3	6628.0		139.6	55.1	235.6	56.8	1146.9	39.3	1723.3	8353.2					
309	2-Aug-94	1000.6	8040.4			2	1		3980	2401.6	6381.7		102.5	53.1	226.7	54.7	1103.9	37.8	1659.7	8040.4					
310	3-Aug-94	1000.2	8655.6			3	1		4144.5	2725.4	6869.9		196.5	57.1	244.1	58.9	1188.4	40.7	1785.7	8655.6					
311	4-Aug-94	999.8	8946.6			3	1		4222.3	2878.6	7100.9		203.1	59	252.3	60.8	1228.4	42	1845.7	8946.6					
312	5-Aug-94	999.4	9022.8			2	1		3474.7	3686.7	7161.4		204.8	59.6	254.4	61.4	1238.8	42.4	1861.4	9022.8					
313	6-Aug-94	998.8	8555.8			2	1		3372.4	3418.3	6790.7		194.2	56.5	241.3	58.2	1174.7	40.2	1765.1	8555.8					
314	7-Aug-94	998.2	8086.8			2	1		3269.7	3148.8	6418.5		183.6	53.4	228	55	1110.3	38	1668.3	8086.8					
315	8-Aug-94	997.5	8447.6			2	1		2458.6	4266.3	6724.9		131.8	55.8	239.2	57.4	1159.9	39.7	1742.7	8447.6					
316	9-Aug-94	996.9	9069.7			2	1		2558.6	4640	7198.6		205.9	59.9	255.8	61.7	1245.3	42.6	1871.1	9069.7					
317	10-Aug-94	996.4	8930.7			2	1		2536.2	4521.1	7057.3		202.7	58.9	251.8	60.7	1226.2	42	1842.4	8930.7					
318	11-Aug-94	995.9	8345.1			2	1		2442.1	4181.4	6623.5		189.4	55.1	235.3	56.7	1145.8	39.2	1721.6	8345.1					
319	12-Aug-94	995.3	9281			2	1		2431.8	4140.9	6572.6		188	54.7	233.5	56.3	1137	38.9	1708.4	9281					
320	13-Aug-94	994.8	8264.8			1			6559.8	6559.8			187.6	54.5	233.1	56.2	1134.8	38.8	1705	8264.8					
321	14-Aug-94	994.3	8276.9			1			6569.4	6569.4			187.9	54.6	233.4	56.3	1136.4	38.9	1707.5	8276.9					
322	15-Aug-94	993.8	7930.8			1			6294.7	6294.7			180	52.3	223.6	53.9	1088.9	37.3	1636.1	7930.8					
323	16-Aug-94	993.3	8512.1			1			6756.1	6756.1			193.2	56.2	240	57.9	1166.7	40	1756	8512.1					
324	17-Aug-94	992.8	8342.9			1			6621.8	6621.8			189.4	55.1	235.3	56.7	1145.5	39.2	1721.1	8342.9					
325	18-Aug-94	992.3	9607.8			1			7625.7	7625.7			218.1	63.4	270.9	65.3	1319.2	45.2	1982.1	9607.8					
326	19-Aug-94	991.6	9746			1			7735.4	7735.4			221.2	64.3	274.8	66.3	1338.1	45.8	2010.6	9746					
327	20-Aug-94	990.9	10047.9			1			7974.9	7974.9			228.1	66.9	283.9	68.9	1379.6	47.7	2077.9	10047.9					

Columns V-AG																									
V	W	X	Y	Z	AA	AB	AC	AD	AE	AF	AG	AH	AI	AJ	AK	AL	AM	AN	AO	AP	AQ				
Sluice Gate Flows - cfs				Drum Spillway flow - cfs	Temperature Target - F	Shutter Temperatures - F				TCD Leakage Temperature (by elevation range) - F							Generation Temperature - F	Sluice Gate Temperatures - F			Drum Spillway Temperature - F				
Upper	Middle	Lower	Total		Target - F	top	middle	penstock	lower	1000 (Over)	918	945-900	900-831	831-804	804-780	780-750	F	Upper	Middle	Lower	F				
1				51.2	73	65.4	52.5	46.5			71.8	64.5	54.7	51.2	49.6	48.1	51.2								
4					49.7	74.3	57.4	49.8	48.1		64.1	54.3	50.1	49.3	48.9	48.5	49.6								
2					49.7	74.6	57.6	49.8	48.1		64.3	54.4	50.1	49.3	48.9	48.5	49.6								
4					49.7	74.5	57.6	49.9	48.1		64.5	54.5	50.1	49.3	49	48.5	49.6								
1					49.7	75	57.8	49.9	48.1		64.6	54.7	50.2	49.4	49	48.5	49.7								
7					49.7	75.1	58.2	50	48.1		65.9	55.2	50.3	49.4	49	48.6	49.8								
9					49.7	75.1	58.4	49.9	48.2		65.9	55.3	50.3	49.5	49.1	48.6	49.7								
2					49.7	75.1	58.5	50	48.2		66	55.5	50.4	49.5	49.1	49.6	49.7								
4					49.7	75.1	58.7	50	48.2		66.1	55.6	50.4	49.5	49.1	48.6	49.8								
6					49.7	75.3	58.8	50.1	48.2		66.4	55.7	50.5	49.6	49.2	48.7	49.8								
8					49.7	75.1	58.9	50.1	48.2		66.6	55.9	50.5	49.6	49.2	48.7	49.8								
8					49.7	75.3	59.1	50.1	48.3		66.7	56.1	50.6	49.6	49.2	48.7	49.7								
8					49.7	75.7	59.8	50.2	48.3		67.7	56.7	50.7	49.7	49.3	48.8	49.8								
8					49.7	75.6	59.9	50.2	48.3		67.8	56.8	50.7	49.8	49.3	48.8	49.8								
6					49.7	75.5	59.9	50.2	48.4		68	56.9	50.8	49.8	49.3	48.8	49.6								
7					49.7	75.1	60	50.2	48.5		68	57.1	50.9	49.9	49.4	48.9	49.7								
7					49.7	75.1	60.1	50.3	48.5		68.1	57.2	50.9	49.9	49.4	48.9	49.7								
1					49.7	75.2	60.7	50.4	48.5		69	57.7	51.1	50	49.5	48.9	49.8								
1					49.7	75.2	60.8	50.4	48.5		69	57.8	51.1	50	49.6	49	49.8								
9					49.2	75.2	61	50.9	48.7		69.1	58	51.2	50.1	49.6	49	49.4								
8					49.2	75.2	61.1	50.9	48.7		69.2	58.1	51.3	50.2	49.7	49.1	49.5								
9					49.2	75.3	61.1	51	48.8		69.2	58.3	51.4	50.2	49.7	49.1	49.5								
1					49.2	75	61.4	51.2	48.9		69.3	58.5	51.4	50.3	49.8	49.2	49.6								
9					49.2	75	61.5	51.2	48.9		69.3	58.6	51.5	50.3	49.9	49.3	49.6								
8					49.2	74.6	61.9	51.4	49		70.2	59.6	51.7	50.4	50	49.4	49.7								
6					49.2	74.6	62	51.5	49		70.3	59.8	51.8	50.5	50	49.4	49.8								

1
2 **Figure 6B.C.6 Example Shasta Outlet Operations File Generated in the Model (The**
3 **file is titled “TCD_xx.log.2xl after the Trinity-Sacramento River model is run”)**

4 Columns D-K list the number of shutters and flow allocation to the top, middle,
5 penstock and lower levels. Columns M-S list the leakage flows by elevation
6 ranges. (Note that these leakage flows may have changed due to shutter
7 maintenance and modification.)

8 Column C equals columns L+T (total release and power flow components) and
9 are identical except when the power flow capacity is exceeded. When the total
10 release exceeds the allowable power flow, the excess is allocated to the sluice gate
11 with the temperature nearest the temperature objective. Use of the spillway
12 occurs only after the power and sluice gate are fully utilized. Columns V-Z list
13 the sluice gate and spillway flows.

14 The remaining columns report water temperatures. The shutter temperatures
15 (AB-AE) are reported for all possible levels even though there may be no flow.

1 Temperatures for all possible leakage levels appear in columns AF-AL. Columns
 2 AA and AM report the temperature object and the power flow temperature
 3 respectively. The remaining columns report the sluice and spillway temperatures
 4 only when there is flow.

5 **6B.C.6.3 Folsom Dam**

6 **6B.C.6.3.1 Seasonal Temperature Target Schedule**

7 A Folsom Dam release temperature target scheduling procedure for the American
 8 River model was developed using logic that was derived from the NMFS BO and
 9 actual temperature management operations provided by Reclamation. The
 10 spreadsheet generates a PT record that is referenced at line 262 in the American
 11 River HEC-5Q data file.

12 **6B.C.6.3.2 Selective Withdrawal Operations**

13 The shutter position and power bypass are set to meet the temperature targets
 14 based on the Folsom-specific data described below. Figure 6B.C.7 shows the
 15 relevant input data for Folsom Dam in the American River HEC-5Q data file and
 16 has additional comments that supplement this text. (Note that the line numbers are
 17 for reference only and are not line numbers in the American River HEC-5Q
 18 data file.)

```

11 c... Folsom Dam shutter operation (Reference Figure 5, 2013 project report)
12 c. P1 - Centerline of the power penstocks
13 c. P2 thru P4 - Centerline elevation of the shutter openings (crest elevation + 26/2)
14 c. Center line 307 Power Penstocks
15 c. Crest elev 336 362 401 (add 13' to crest elevation - P2, P3 & P4 of L7 Record)
16 c. Note that the depth of submergence "Dout" is referenced to the centerline of the equivalent port representation
17 c. e.g. elevation submergence limit for the upper port is 414+20-401 = 33' The minimum required
18 c. submergence is 27' so the L7 data provide a 6' safety factor (approx 1/2 the height of each shutter)
19 c. Minimum fraction of flow through any port before any change | |
20 c Aout Qmax P1 P2 P3 P4 P5 P6 Dout
21 c. CL/crest elev 307 336 362 401 (add 13' to crest elevation - P2, P3 & P4)
22 L7 400 8000 307 349 375 414 20 1 .10
23 c.. check this ^^^^^ may be 290'??? 307' from Figure 5, August 2013 report
24 c. Two adjacent ports may be operated, flow allocation between ports as a function of target temperature.
25 c. The character string "Save opp:" combined with the Control Point Number 590 triggers this outlet option
26 c. The output file "Folsom.TCD.Opp" summarizes outlet structure operation. "FOLSOM.TCD.2XLS" is a
27 c. comma delimited reformatted version of the summary table.
28 c. The word "lower" followed by a series of months defines the period when all shutters are lowered
29 c. (subject to elevation constraints) Two shutter operation approaches during spilling are available.
30 c. If "spill#1" is present of the Save_opp record (example), all shutters lowered with all units at 2,680 cfs
31 c. If "spill#2" is present, two elevations for the three shutters are based on temperature objective
32 c. (e.g., two at 5,360 cfs, one at 2,680 cfs) - both options subject to submergence constraints
33 c. (subject to elevation constraints)
34 c. The "plus" option will add an elevation increment (ft) to the withdrawal elevation to delay adding a shutter (raising environment)
35 Save opp: Folsom.TCD.Opp Lower Dec Jan Feb March spill#1
    
```

19

20 **Figure 6B.C.7 Input Data Relevant to the Folsom Dam Selective Withdrawal**
 21 **Procedure in the American River HEC-5Q Data File**

22 Line 19 (L5) defines the low level outlet characteristics that serves as the power
 23 bypass outlet. The first 72 columns are standard inputs while the additional data
 24 beyond column 72 control operation of the power bypass. The following three
 25 inputs provide limit on flow and date limits for power bypass.

- 26 • Col 73-80: Maximum fraction of flow through the low level power bypass
- 27 • Col 81-88: Minimum fraction of flow through the low level power bypass
- 28 • Col 89-96: Maximum flow through the low level power bypass
- 29 • Col 97-112: Calendar date limits for power bypass to the low level outlet

1 Line 29 (L7) is a standard input for representing a multi-port withdrawal
2 structure. For the Folsom Lake TCD (shutters) option, the standard inputs are
3 used to define the penstock (all shutters raised) and three possible shutter
4 elevations and the shutter submergence criteria. The value defined in columns
5 81-88 (.10) is the threshold fraction of the total flow required for a shutter change.

6 Line 36 initiates the Folsom Dam-specific option. The character string "Save
7 opp:" ("USBR_opp" is an alternate flag) combined with the control point number
8 590 triggers this outlet operation option. Two adjacent shutters are operated and
9 flow is allocation between shutters to provide an outflow that approximates the
10 target temperature. Following the file naming, a series of months (e.g., December
11 thru March) may be included to specify that shutters be set in the lowered
12 position. During tainter gate operation, the shutters are operated to meet the
13 temperature objective after correcting for the temperature of the spill. Including
14 "SPILL#1" following the months will force the outflow at the highest possible
15 level, thus conserving the cold water resource.

16 **6B.C.6.3.3 Folsom Dam Operations Output**

17 There are two output files generated by the Folsom-specific option. The
18 "Folsom.TCD.Opp" is a text file that is produced as the simulation progresses.
19 This text file is reformatted to produce a file with a "2xls" file extension upon
20 completion of the temperature simulation (this file will not be created if the run
21 ends prematurely). This comma-delimited file, when imported into Excel,
22 produces a file that summarizes the Folsom shutter operation and power bypass.
23 The file includes daily flow allocation, outflow temperature, temperature
24 compliance, lake elevation and storage information. An example of the resulting
25 Excel file is shown on Figure 6B.C.8. There are two flags in column A that
26 indicate operation constrained by lake elevation or specified shutter lowering.
27 Shutter changes are indicated by "TRUE" in column C. Shutter changes are
28 indicated when a shutter level is discontinued and when a new shutter level is
29 added. In reality, the two shutter changes indicated on September 22 and 26
30 would actually be one change in which the "middle raised" shutter (one or two
31 shutter bays) would remain unchanged while both remaining shutters in the
32 "upper raised" position would be removed to move from the "upper raised"
33 condition to the "lower raised" condition. The number of shutter bays at the
34 indicated level is not considered in the flow allocation. Therefore, the total
35 generation flow for a shutter level may exceed the capacity of a single penstock.
36 Power bypass assumes that all shutters are raised and the power bypass fraction is
37 indicated only by flow. There are temperatures circled in red in the sample output
38 that have no corresponding flow. These temperatures indicate that a shutter
39 change would have occurred if not for the minimum flow requirement.

Shutter Position (U=Upper raised, M=Middle raised, L=Lower raised, A=All lowered)		Elem# elevation constrained		Lower specified lowering per "Save opp" record																							
Flag	Date	Change	% of Q	Q-Out	T-Out	% of Q	Q-Out	T-Out	% of Q	Q-Out	T-Out	% of Q	Q-Out	T-Out	Q-Out	T-Out	Q-Out	T-Out	Q-Out	T-Out	Q-Out	T-Out	Q-Out	T-Out	Q-Out	T-Out	
1-Jan-22	TRUE	0	0	0	0	100	1737	49.11	0	0	0	0	0	0	0	0	0	0	0	1737	49.11	52	-2.89	465.98	418.751	0	0
2-Jan-22		0	0	0	0	100	1737	49.05	0	0	0	0	0	0	0	0	0	0	0	1737	49.05	52	-2.95	406	418.905	0	0
3-Sep-22		0	0	74.09	0	100	5102.9	59.79	0	0	0	0	0	0	0	0	0	0	0	5102.9	59.79	68.4	-0.61	465.79	763.401	0	0
4-Sep-22		0	0	75.34	0	100	5102.91	60.33	0	0	0	0	0	0	0	0	0	0	0	5102.9	60.33	68.4	-0.07	444.96	795.062	0	0
5-Sep-22		0	0	0	0	100	5102.9	60.5	0	0	0	0	0	0	0	0	0	0	0	5102.9	60.5	68.4	0.1	444.12	746.687	0	0
6-Sep-22		0	0	0	0	100	5102.9	60.87	0	0	0	0	0	0	0	0	0	0	0	5102.9	60.87	68.4	0.47	443.28	738.251	0	0
7-Sep-22	TRUE	0	0	0	0	100	5102.9	60.96	0	0	0	0	0	0	0	0	0	0	0	5102.9	60.96	68.4	0.56	442.44	730.062	0	0
8-Sep-22		0	0	0	0	98	4490.56	61.44	12	412.35	52.58	0	0	0	0	0	0	0	0	5102.9	60.37	68.4	-0.03	441.58	721.032	0	0
9-Sep-22		0	0	0	0	96	4388.5	61.61	14	714.41	52.68	0	0	0	0	0	0	0	0	5102.9	60.36	68.4	-0.04	440.73	713.535	0	0
10-Sep-22		0	0	0	0	81	4133.35	62.39	19	969.55	53.22	0	0	0	0	0	0	0	0	5102.9	60.65	68.4	0.25	439.87	704.983	0	0
11-Sep-22		0	0	0	0	77	3929.24	63.01	23	1173.67	53.44	0	0	0	0	0	0	0	0	5102.9	60.81	68.4	0.41	439	696.593	0	0
12-Sep-22		0	0	0	0	70	3572.03	63.06	30	1530.87	53.89	0	0	0	0	0	0	0	0	5102.9	60.31	68.4	-0.09	438.13	688.269	0	0
13-Sep-22		0	0	0	0	68	3485.98	63.89	32	1623.93	54.24	0	0	0	0	0	0	0	0	5102.9	60.76	68.4	0.36	437.25	679.918	0	0
14-Sep-22		0	0	0	0	60	3061.74	64.21	40	2045.16	54.59	0	0	0	0	0	0	0	0	5102.9	60.37	68.4	-0.03	436.37	671.565	0	0
15-Sep-22		0	0	0	0	54	2785.57	64.7	46	2347.33	55.18	0	0	0	0	0	0	0	0	5102.9	60.32	68.4	-0.08	435.49	663.288	0	0
16-Sep-22		0	0	0	0	51	2602.48	65.01	49	2500.42	55.55	0	0	0	0	0	0	0	0	5102.9	60.37	68.4	-0.03	434.59	654.913	0	0
17-Sep-22		0	0	0	0	42	2143.22	65.82	58	2959.68	56.33	0	0	0	0	0	0	0	0	5102.9	60.32	68.4	-0.08	433.7	646.671	0	0
18-Sep-22		0	0	0	0	39	1980.13	66.23	61	3112.77	56.52	0	0	0	0	0	0	0	0	5102.9	60.31	68.4	-0.09	432.79	638.276	0	0
19-Sep-22		0	0	0	0	28	1428.91	66.94	72	3674.09	57.5	0	0	0	0	0	0	0	0	5102.9	60.14	68.4	-0.24	431.88	629.927	0	0
20-Sep-22		0	0	0	0	25	1275.73	67.22	75	3927.18	58.03	0	0	0	0	0	0	0	0	5102.9	60.33	68.4	-0.07	430.96	621.62	0	0
21-Sep-22		0	0	0	0	18	918.53	67.08	82	4184.38	58.71	0	0	0	0	0	0	0	0	5102.9	60.36	68.4	-0.04	430.04	613.335	0	0
22-Sep-22	TRUE	0	0	0	0	15	765.44	68.42	85	4337.47	59.53	0	0	0	0	0	0	0	0	5102.9	60.66	68.4	0.46	429.11	605.019	0	0
23-Sep-22		0	0	0	0	0	0	68.76	100	5102.9	59.82	0	0	0	0	0	0	0	0	5102.9	59.82	68.4	-0.58	428.17	596.879	0	0
24-Sep-22		0	0	0	0	0	0	0	100	5102.9	60.57	0	0	0	0	0	0	0	0	5102.9	60.57	68.4	0.17	427.22	588.539	0	0
25-Sep-22		0	0	0	0	0	0	0	100	5102.9	60.58	0	0	0	0	0	0	0	0	5102.9	60.58	68.4	0.18	426.27	580.05	0	0
26-Sep-22	TRUE	0	0	0	0	0	0	0	100	5102.9	61.31	0	0	0	0	0	0	0	0	5102.9	61.31	68.4	0.91	425.31	571.733	0	0
27-Sep-22		0	0	0	0	0	0	0	89	4541.58	61.73	11	561.32	60.65	0	0	0	0	0	5102.9	60.44	68.4	0.04	424.35	563.499	0	0
28-Sep-22		0	0	0	0	0	0	0	86	4389.5	62.14	14	714.41	58.2	0	0	0	0	0	5102.9	60.47	68.4	0.07	423.37	555.167	0	0
29-Sep-22		0	0	0	0	0	0	0	82	4184.38	62.73	18	3183.52	58.48	0	0	0	0	0	5102.9	60.52	68.4	0.12	422.39	546.901	0	0
30-Sep-22		0	0	0	0	0	0	0	79	4031.29	63.11	21	1071.61	58.57	0	0	0	0	0	5102.9	60.48	68.4	0.08	421.39	538.558	0	0

Figure 6B.C.8 Example Folsom Outlet Operations File Generated when Running the Model (The file is titled “Folsom.TCD.Opp.txt after the American River model is run”)

The other Folsom operations output (Figure 6B.C.9) is a text file that summarizes the Folsom TCD operation. The file is named “WS_TCD.txt” and includes the operational information seen below. The output is daily except when the reservoir element location changes and there is an additional line of output during that day.

```

CP 590: sliding diversion intake between 61 320.00
and 147 460.00

Elem Height Resel Temp(F)
01-JAN-1922 06:00 105 391.48 405.95 49.10
02-JAN-1922 06:00 105 391.48 405.98 49.19
03-JAN-1922 06:00 105 391.48 406.03 49.02
04-JAN-1922 06:00 105 391.48 406.08 48.95
05-JAN-1922 06:00 105 391.48 406.14 48.82
06-JAN-1922 06:00 105 391.48 406.19 48.75
07-JAN-1922 06:00 105 391.48 406.24 48.64
08-JAN-1922 06:00 105 391.48 406.29 48.60
09-JAN-1922 06:00 105 391.48 406.34 48.55
10-JAN-1922 06:00 105 391.48 406.39 48.36
11-JAN-1922 06:00 105 391.48 406.44 48.19
    
```

Figure 6B.C.9 Example Folsom TCD Operations File Generated when Running the Model (The file is titled “WS_TCD.txt after the American River model is run”)

6B.C.7 Quality Assurance/Quality Control

This section describes two different elements of the QA/QC process used to ensure the quality for the Toolkit. The first section describes the update and review process for the Toolkit. The second section describes the spreadsheets that were developed to perform a QA/QC process on application model runs from the Toolkit.

1 **6B.C.7.1 Update and Review Process**

2 Three QA/QC spreadsheet tools were also developed as part of the updates to the
3 Toolkit. The spreadsheet tools are designed to be used for a QA/QC process of all
4 application model runs from the Toolkit.

5 **6B.C.7.1.1 CalSim II and HEC-5Q Comparison Spreadsheet**

6 The first spreadsheet tool HEC5Q_CalSim II_QA/QC_[River
7 Model]_rev06_011615_Template_NAA_Example compares CalSim II storages
8 and flows with HEC-5Q storages and flows to ensure that storages and flows are
9 translating correctly. A procedure for performing a QA/QC of CalSim II and
10 HEC-5Q flows and storages is described in the spreadsheet. Minor differences
11 between CalSim II input flows and HEC-5Q output flows are expected because
12 HEC-5Q storages and flows are modified to meet downstream temperature
13 targets. In addition, not all HEC-5Q output locations map well with CalSim II
14 nodes, which can cause significant flow differences. The flow mapping task
15 reduced this issue but additional changes to CalSim II are required. Expected
16 differences for each HEC-5Q location are described in the spreadsheet and
17 deviations from those expected results are recommended to be investigated for
18 potential issues.

19 **6B.C.7.1.2 HEC-5Q Alternative Comparison Spreadsheet**

20 The second spreadsheet tool HEC-5Q_AltCompare_[River
21 Model]_rev03_012715_Template_Example compares HEC5Q storages, flows,
22 and temperatures between two alternatives to ensure that temperature results make
23 logical sense based on flow and storage differences. A procedure for performing
24 a temperature comparison procedure is described in the spreadsheet. This
25 spreadsheet assumes that a comparison procedure of flows and storages
26 differences has been already been completed as part of review of CalSim II results
27 and that the flow and storage differences are accurate. Use of this spreadsheet
28 requires the user to have performed a prior HEC-5Q and CalSim II QA/QC
29 procedure with the tool described previously for both alternatives. It also requires
30 the user to have a prepared expectation of temperature differences based on their
31 knowledge of the differences between the alternatives.


32 **6B.C.7.1.3 Operation Diagnostic Spreadsheets**

33 The third spreadsheet tool is an operation diagnostic tool [Reservoir]
34 _Operations_Diagnostic_rev01_030515. There is one for Shasta, Trinity, and
35 Folsom Dams. The purpose of the tool is to graphically display the flows and
36 temperatures through the various temperature control structures and outlets for
37 Shasta, Trinity, and Folsom Dams to view how the reservoirs are operating to
38 meet downstream temperature targets.


39 **6B.C.8 Trinity-Sacramento River Model Validation**

40 This section provides comparisons between observed temperature data and
41 computed temperature results from the validation task for the Trinity-Sacramento

- 1 River. Figures 6B.C.10 through 6B.C.42 present geographic locations used in the
- 2 HEC-5Q Model and comparisons of observed and computed data at these
- 3 locations. Observed results are from Reclamation, Department of Water
- 4 Resources (DWR), and U.S. Geological Survey (USGS) data. The results
- 5 indicate overall good agreement between computed and observed data.

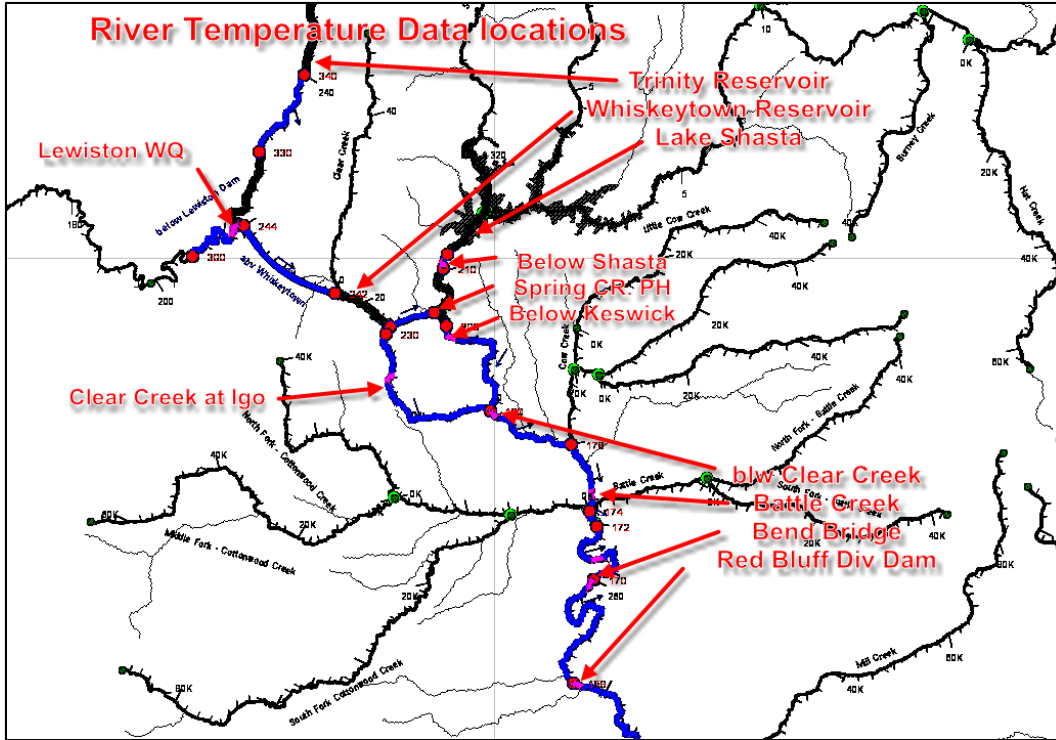


- 6
- 7 **Figure 6B.C.10 Schematic of the Trinity-Sacramento River HEC-5Q Model Upstream**
- 8 **of Red Bluff Diversion Dam Location**

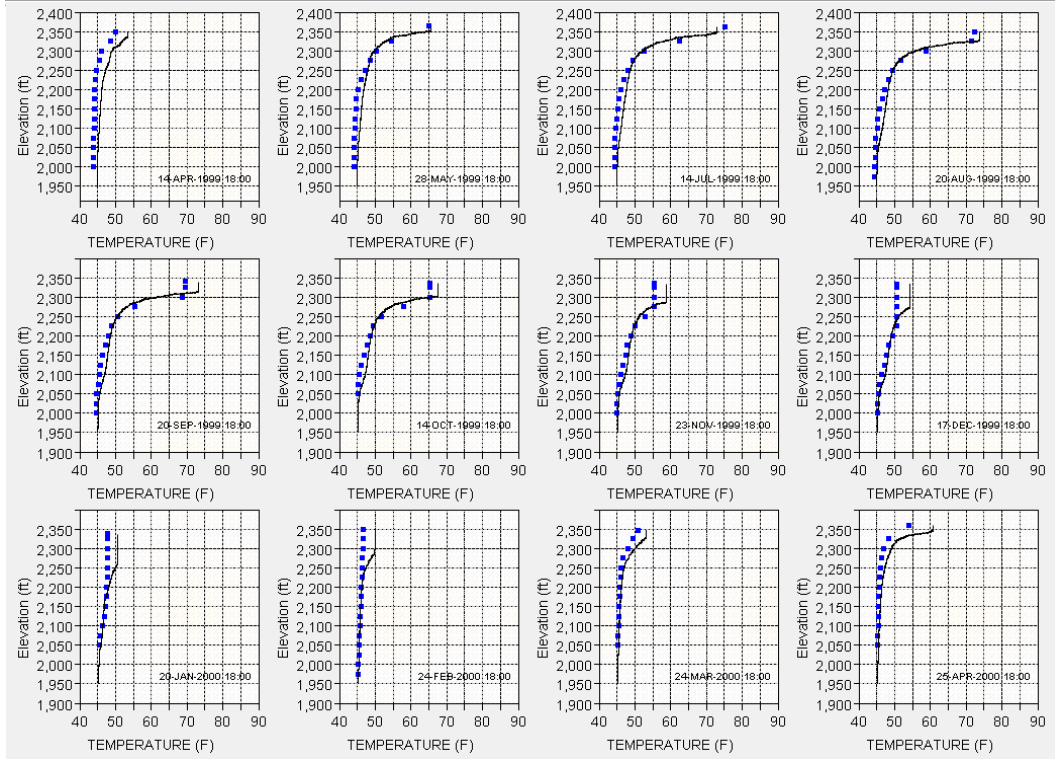


1

2 **Figure 6B.C.11 Trinity Lake Observed (blue dots) and Computed (black line)**
 3 **Temperature Profiles Resulting from the Trinity-Sacramento River Validation**

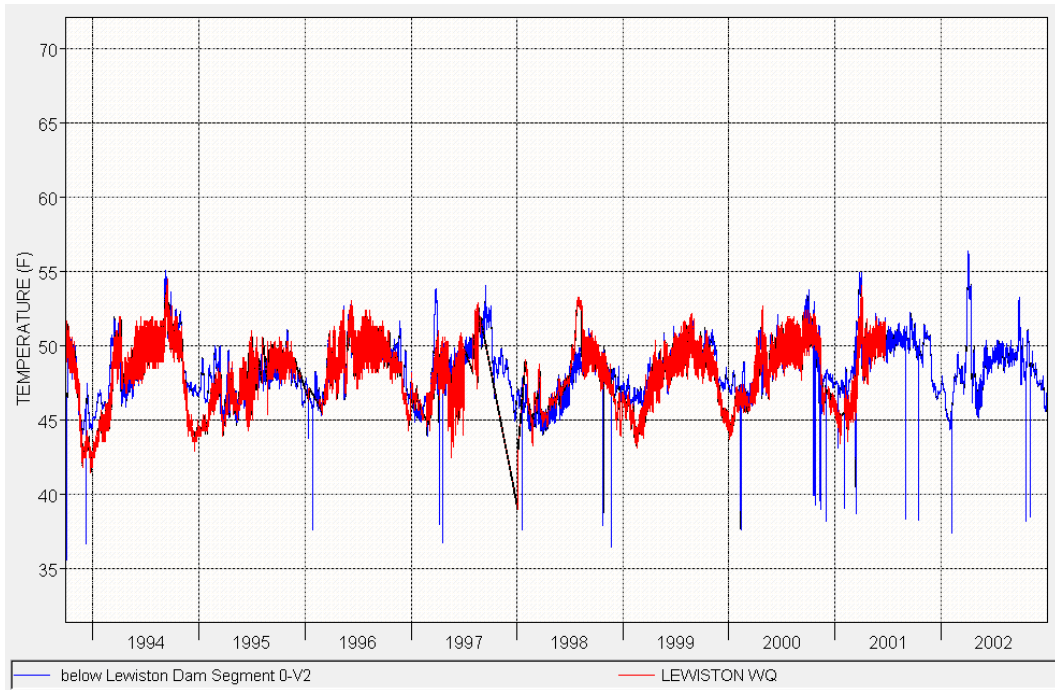

4

5 **Figure 6B.C.12 Trinity River below Lewiston Dam Observed (red) and Computed**
 6 **(blue) Temperature Time Series Resulting from the Trinity-Sacramento River**
 7 **Validation**

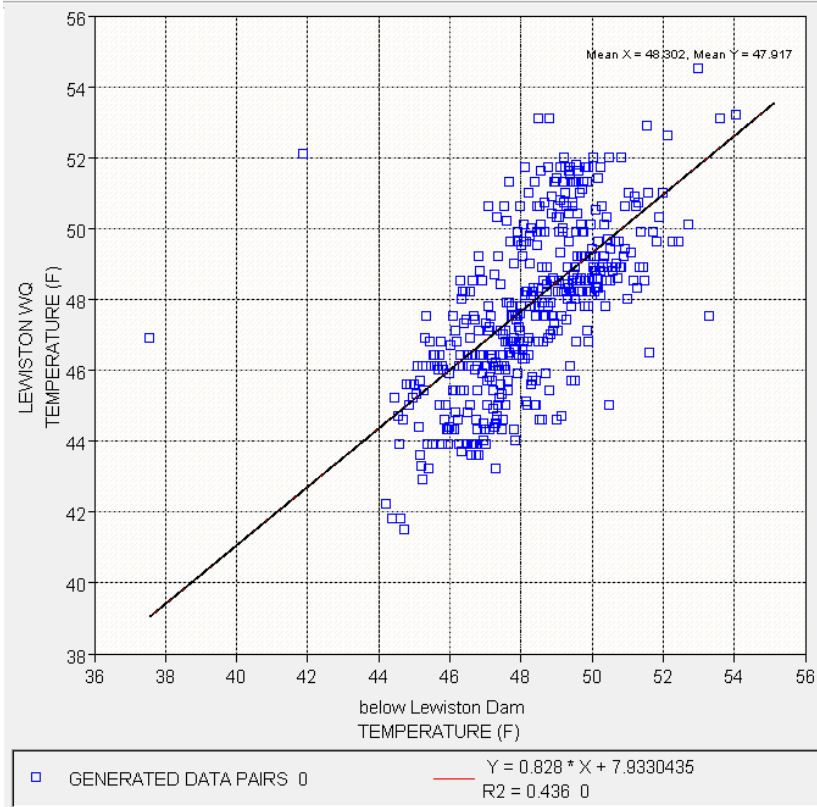

1


2 **Figure 6B.C.13 Trinity River below Lewiston Dam Observed (Y-Axis) and Computed**
 3 **(X-axis) Temperature Data Pairs Resulting from the Trinity-Sacramento River**
 4 **Validation**

5 **Table 6B.C.5 Trinity River below Lewiston Dam Computed and Observed Statistical**
 6 **Comparison**

Period	Values	Computed (oF)	Observed (oF)	Bias (oF)	RMS Differences (oF)	Mean Differences (oF)
Jan	356	46.60	45.23	1.37	2.04	1.77
Feb	394	46.59	45.60	1.00	1.73	1.37
Mar	468	47.99	46.99	1.00	2.04	1.57
Apr	468	47.79	48.06	-0.27	1.77	1.31
May	490	48.08	48.16	-0.08	1.47	1.12
Jun	452	48.71	48.91	-0.20	1.73	1.42
Jul	336	49.24	49.82	-0.58	1.96	1.72
Aug	344	49.68	50.21	-0.53	1.98	1.72
Sep	356	49.85	49.97	-0.12	1.49	1.22
Oct	366	49.64	49.47	0.16	1.68	1.16
Nov	354	48.58	48.01	0.57	1.58	1.15


Appendix 6B.C: Surface Water Temperature Modeling – HEC-5Q Model Update

Period	Values	Computed (oF)	Observed (oF)	Bias (oF)	RMS Differences (oF)	Mean Differences (oF)
Dec	296	47.29	45.48	1.81	2.01	1.82
Jan-Mar	1218	47.13	46.02	1.11	1.94	1.56
Apr-Jun	1410	48.19	48.37	-0.18	1.66	1.28
Jul-Sep	1036	49.60	50.00	-0.40	1.82	1.55
Oct-Dec	1016	48.58	47.80	0.79	1.75	1.35
Average Year	4680	48.31	48.00	0.31	1.79	1.43

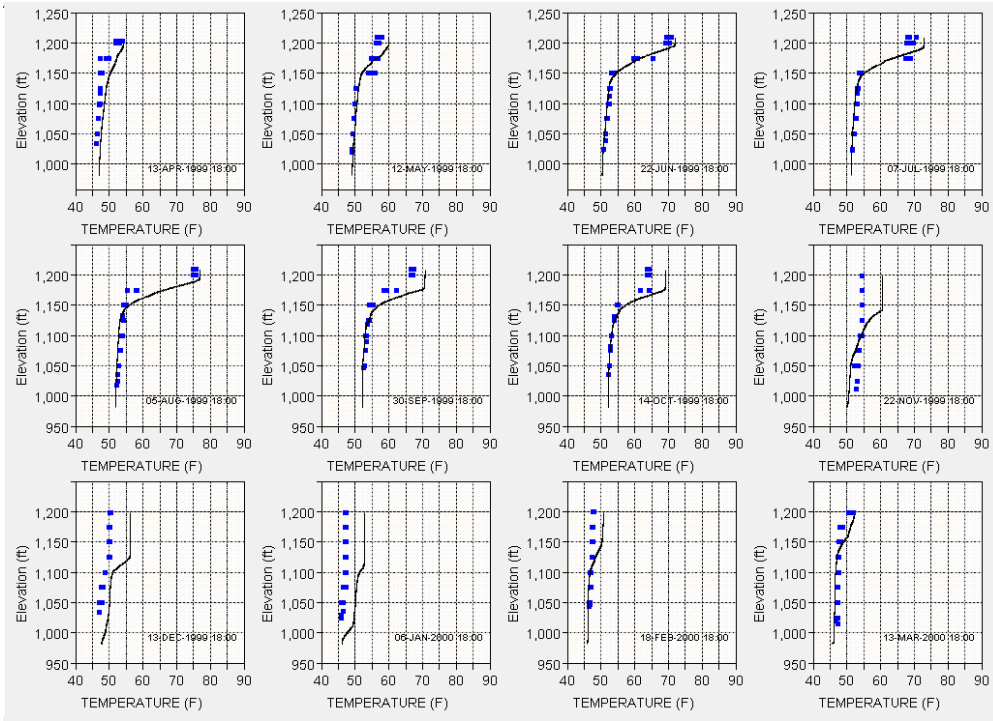


1

2 **Figure 6B.C.14** Whiskeytown Lake Observed (blue dots) and Computed (black line)
 3 **Temperature Profiles Resulting from the Trinity-Sacramento River Validation**

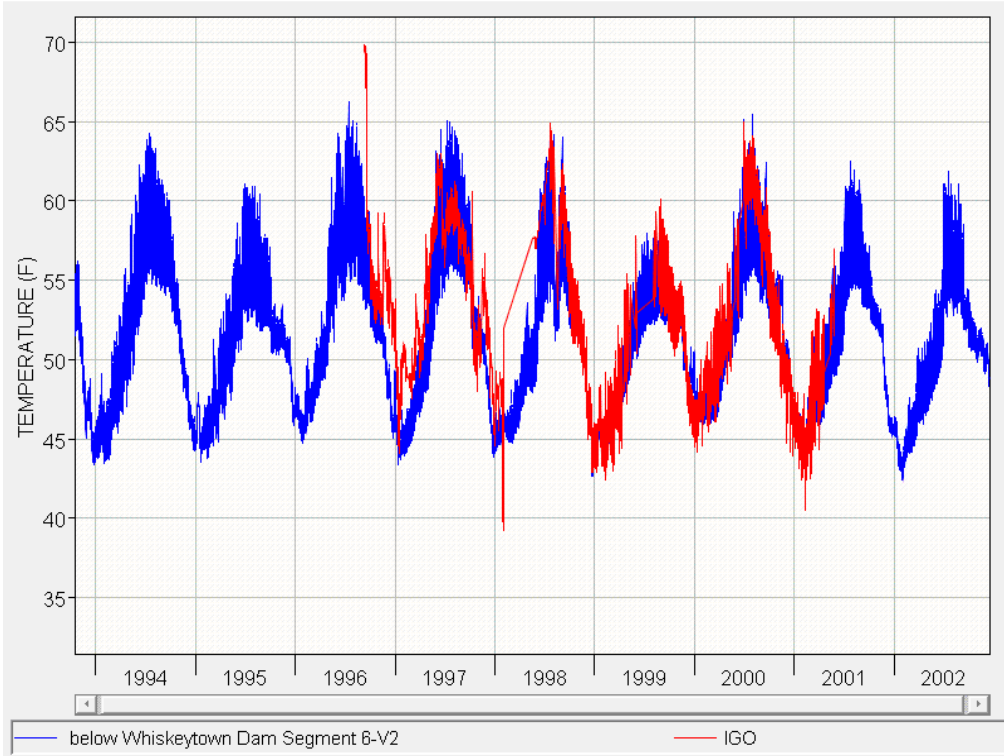

1

2 **Figure 6B.C.15 Clear Creek below Whiskeytown Lake Observed (red) and**
 3 **Computed (blue) Temperature Time Series Resulting from the Trinity-Sacramento**
 4 **River Validation**

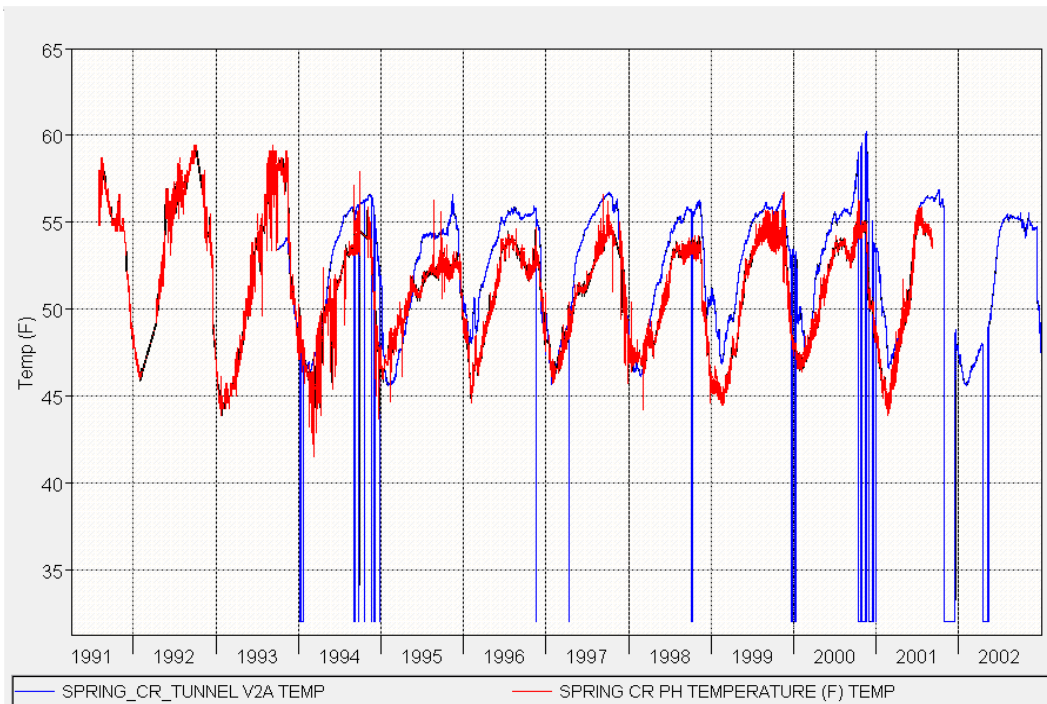


5

6 **Figure 6B.C.16 Spring Creek Powerhouse Observed (red) and Computed (blue)**
 7 **Temperature Time Series Resulting from the Trinity-Sacramento River Validation**

1 **Table 6B.C.6 Clear Creek below Whiskeytown Computed and Observed Statistical**
 2 **Comparison**


Period	Values	Computed (°F)	Observed (°F)	Bias (°F)	RMS Differences (°F)	Mean Differences (°F)
Jan	458	47.11	47.07	0.05	5.17	3.15
Feb	432	47.22	46.37	0.85	1.99	1.64
Mar	464	47.95	47.31	0.64	1.75	1.46
Apr	444	49.43	48.76	0.67	2.16	1.34
May	480	50.89	50.44	0.45	0.97	0.79
Jun	458	52.36	51.93	0.43	1.03	0.75
Jul	460	53.23	53.19	0.04	0.74	0.58
Aug	474	53.57	53.57	0.00	0.50	0.36
Sep	418	53.01	53.54	-0.52	3.81	1.22
Oct	326	52.59	53.55	-0.97	6.01	2.44
Nov	352	51.37	53.14	-1.77	8.04	4.06
Dec	414	48.47	49.72	-1.25	6.63	3.82
Jan-Mar	1354	47.43	46.93	0.50	3.37	2.09
Apr-Jun	1382	50.91	50.40	0.51	1.47	0.95
Jul-Sep	1352	53.28	53.43	-0.15	2.18	0.70
Oct-Dec	1092	50.64	51.97	-1.33	6.95	3.48
Average Year	5180	50.56	50.61	-0.05	3.87	1.72

Appendix 6B.C: Surface Water Temperature Modeling – HEC-5Q Model Update

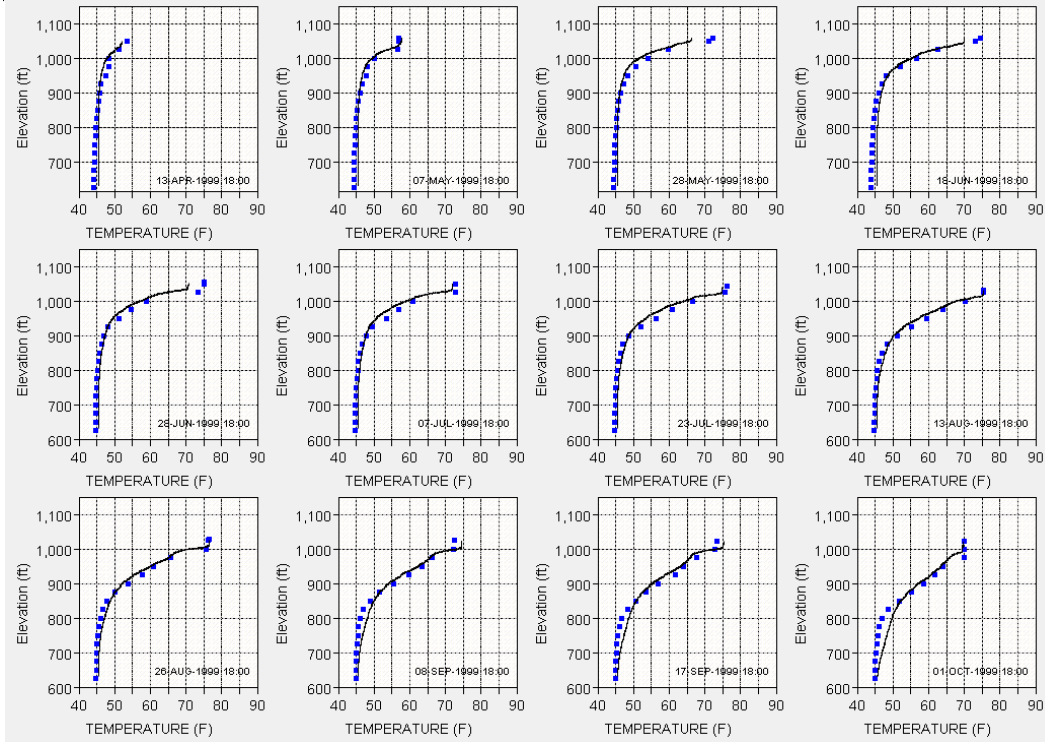


1

2 **Figure 6B.C.17 Shasta Lake Observed (blue dots) and Computed (black line)**
 3 **Temperature Profiles Resulting from the Trinity-Sacramento River Validation**

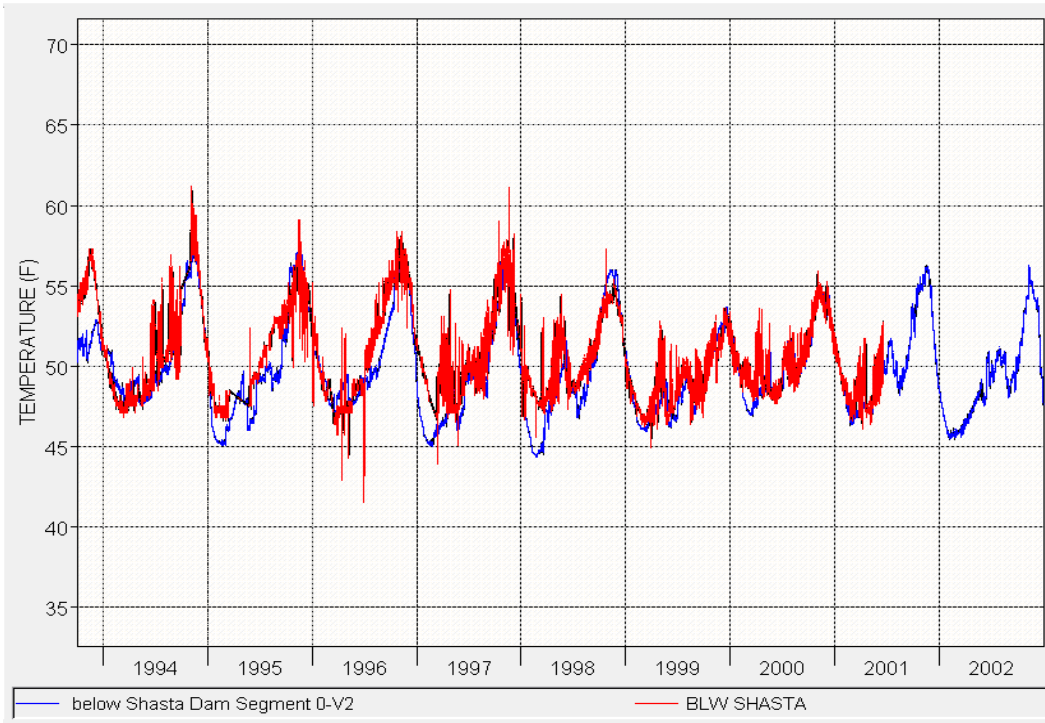

4

5 **Figure 6B.C.18 Sacramento River below Shasta Lake Observed (red) and**
 6 **Computed (blue) Temperature Time Series Resulting from the Trinity-Sacramento**
 7 **River Validation**

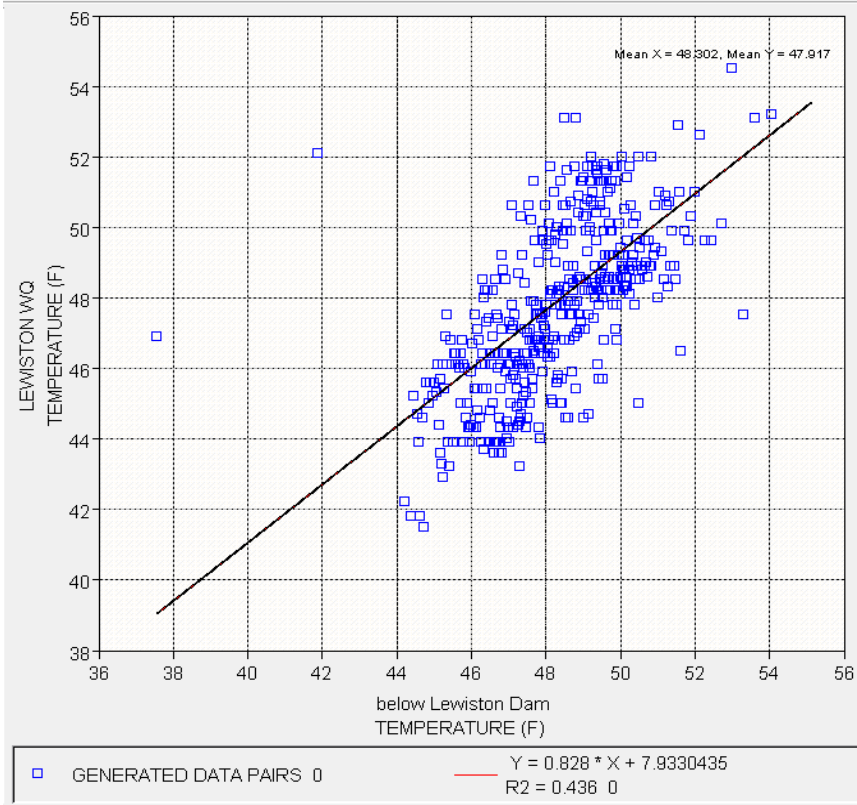


1

2 **Figure 6B.C.19 Sacramento River below Shasta Lake Observed (Y-Axis) and**
 3 **Computed (X-axis) Temperature Data Pairs Resulting from the Trinity-Sacramento**
 4 **River Validation**

5 **Table 6B.C.7 Sacramento River below Shasta Lake Computed and Observed**
 6 **Statistical Comparison**


Period	Values	Computed (°F)	Observed (°F)	Bias (°F)	RMS Differences (°F)	Mean Differences (°F)
Jan	424	49.16	49.82	-0.66	1.69	1.21
Feb	404	47.04	48.19	-1.15	1.92	1.54
Mar	384	46.81	47.89	-1.08	1.83	1.39
Apr	364	47.77	48.74	-0.97	2.12	1.62
May	386	48.27	48.81	-0.54	1.62	1.18
Jun	428	48.46	49.03	-0.56	1.54	1.09
Jul	374	49.19	50.03	-0.84	1.59	1.23
Aug	408	49.40	50.79	-1.39	2.11	1.72
Sep	410	50.80	51.70	-0.90	1.73	1.35
Oct	318	53.10	53.39	-0.28	1.34	1.06
Nov	360	55.27	55.00	0.27	1.49	1.09

Period	Values	Computed (°F)	Observed (°F)	Bias (°F)	RMS Differences (°F)	Mean Differences (°F)
Dec	318	53.05	53.14	-0.09	1.16	0.86
Jan-Mar	1212	47.71	48.66	-0.96	1.81	1.38
Apr-Jun	1178	48.19	48.87	-0.68	1.77	1.28
Jul-Sep	1192	49.81	50.86	-1.05	1.83	1.44
Oct-Dec	996	53.87	53.89	-0.03	1.34	1.01
Average Year	4578	49.72	50.43	-0.71	1.71	1.29

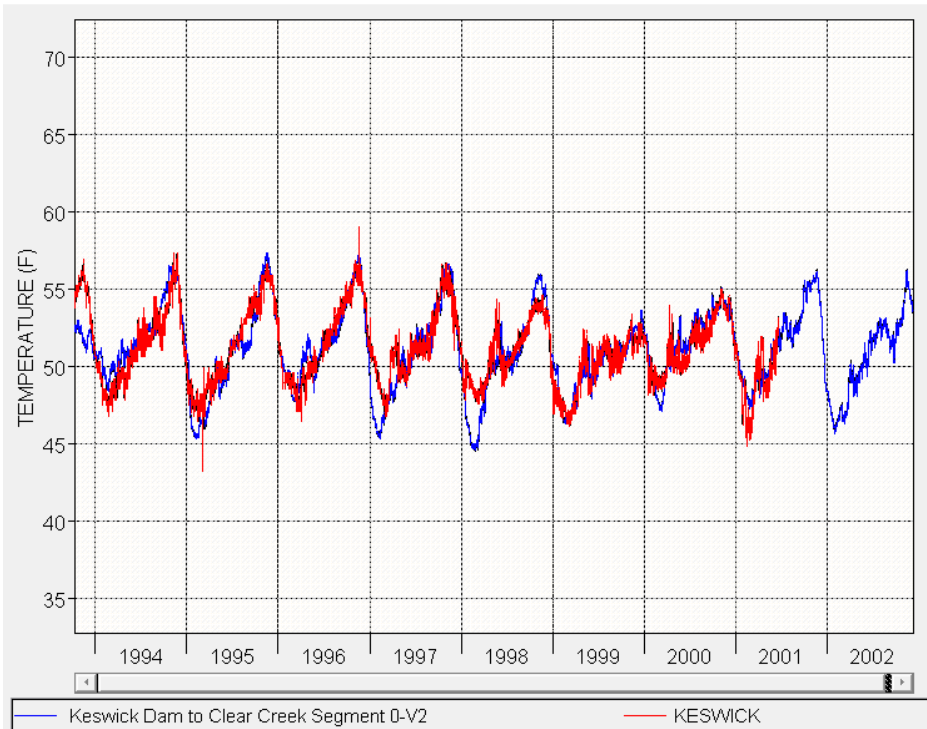

1
 2 **Figure 6B.C.20 Sacramento River below Keswick Dam Observed (red) and**
 3 **Computed (blue) Temperature Time Series Resulting from the Trinity-Sacramento**
 4 **River Validation**

Appendix 6B.C: Surface Water Temperature Modeling – HEC-5Q Model Update

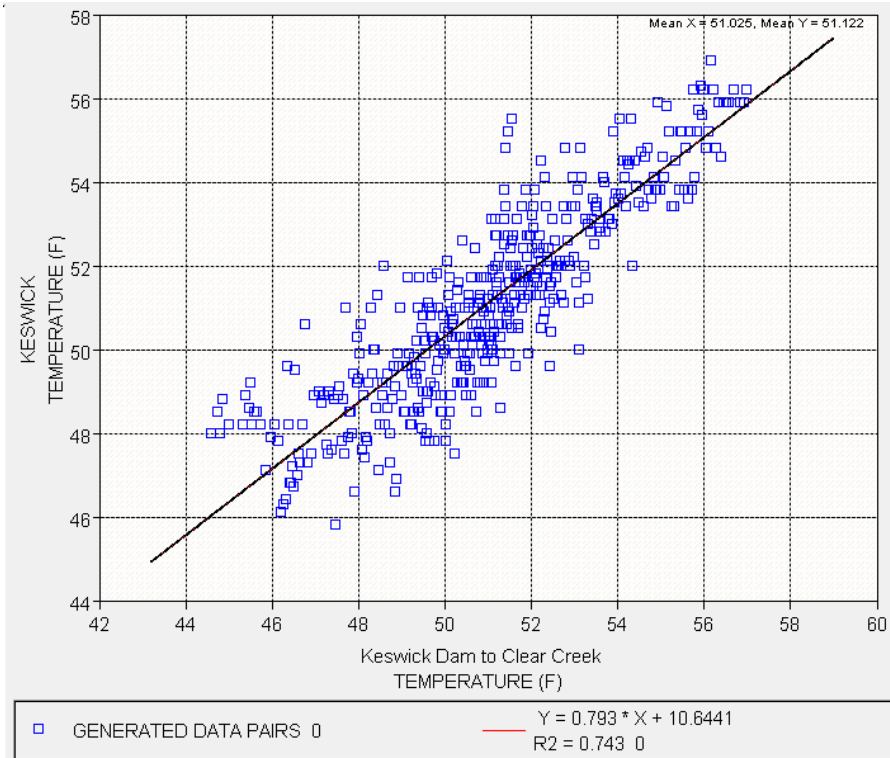


1

2 **Figure 6B.C.21 Sacramento River below Keswick Dam Observed (Y-Axis) and**
 3 **Computed (X-axis) Temperature Data Pairs Resulting from the Trinity-Sacramento**
 4 **River Validation**

5 **Table 6B.C.8 Sacramento River below Keswick Dam Computed and Observed**
 6 **Statistical Comparison**

Period	Values	Computed (°F)	Observed (°F)	Bias (°F)	RMS Differences (°F)	Mean Differences (°F)
Jan	468	49.22	49.52	-0.29	1.85	1.40
Feb	434	47.35	48.08	-0.72	1.89	1.52
Mar	496	47.90	48.25	-0.36	1.41	1.17
Apr	466	49.53	49.65	-0.12	1.43	1.19
May	486	50.20	50.06	0.14	1.22	0.98
Jun	400	50.73	50.47	0.26	0.89	0.71
Jul	402	51.47	51.38	0.09	0.65	0.52
Aug	430	51.68	51.89	-0.21	0.97	0.78
Sep	414	52.62	52.65	-0.03	1.11	0.85
Oct	428	54.20	53.82	0.37	0.95	0.75
Nov	418	55.21	54.69	0.53	0.99	0.82
Dec	426	52.83	52.72	0.11	0.90	0.73


Period	Values	Computed (°F)	Observed (°F)	Bias (°F)	RMS Differences (°F)	Mean Differences (°F)
Jan-Mar	1398	48.17	48.62	-0.45	1.72	1.36
Apr-Jun	1352	50.13	50.04	0.09	1.21	0.97
Jul-Sep	1246	51.92	51.98	-0.05	0.93	0.72
Oct-Dec	1272	54.07	53.74	0.33	0.95	0.77
Average Year	5268	50.99	51.02	-0.03	1.26	0.97

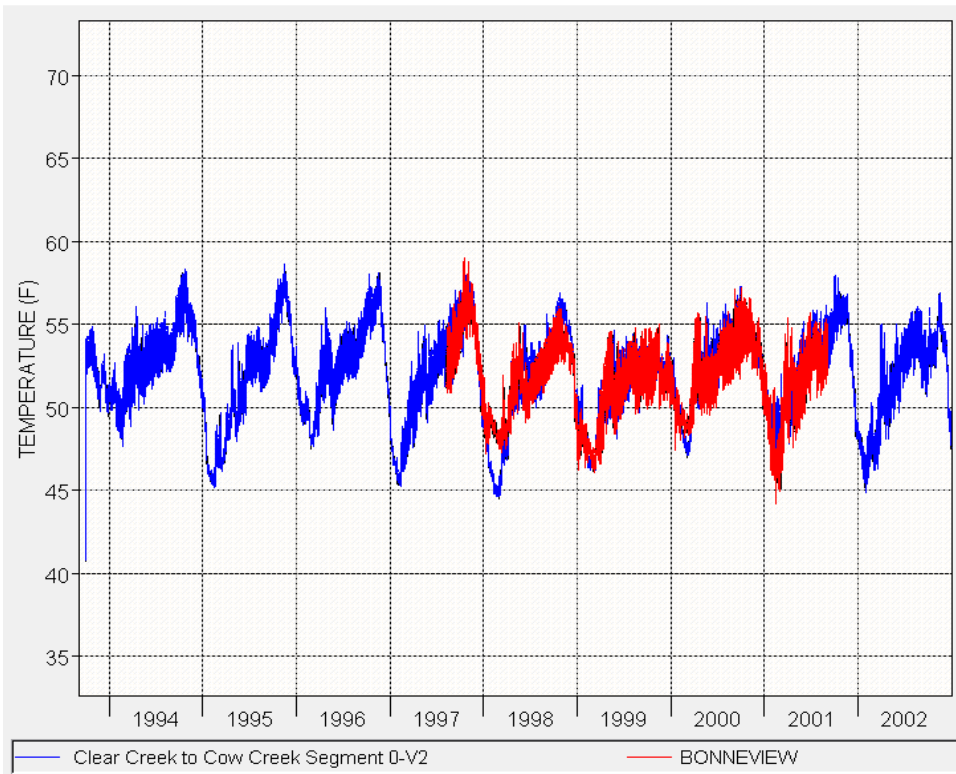

1
2
3
4

Figure 6B.C.22 Sacramento River below Clear Creek Observed (red) and Computed (blue) Temperature Time Series Resulting from the Trinity-Sacramento River Validation

Appendix 6B.C: Surface Water Temperature Modeling – HEC-5Q Model Update

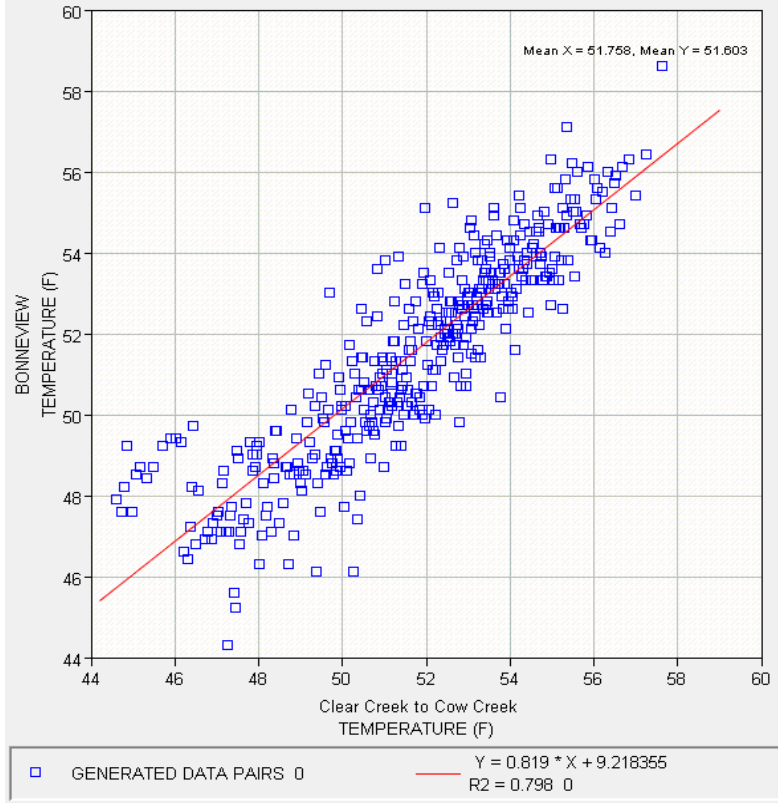


1

2 **Figure 6B.C.23 Sacramento River below Clear Creek Observed (Y-Axis) and**
 3 **Computed (X-axis) Temperature Data Pairs Resulting from the Trinity-Sacramento**
 4 **River Validation**

5 **Table 6B.C.9 Sacramento River below Clear Creek Computed and Observed**
 6 **Statistical Comparison**

Period	Values	Computed (°F)	Observed (°F)	Bias (°F)	RMS Differences (°F)	Mean Differences (°F)
Jan	248	49.39	49.27	0.12	1.41	1.08
Feb	226	47.33	48.08	-0.75	1.98	1.57
Mar	248	48.24	48.80	-0.57	1.36	1.06
Apr	240	50.40	50.93	-0.53	1.29	1.00
May	248	51.56	51.38	0.18	1.44	1.16
Jun	236	52.14	51.39	0.75	1.31	1.11
Jul	242	52.88	52.52	0.36	0.87	0.66
Aug	292	53.11	52.69	0.42	0.85	0.68
Sep	252	53.62	53.41	0.21	0.84	0.66
Oct	248	54.17	54.24	-0.07	0.98	0.77
Nov	240	54.48	53.93	0.55	1.07	0.88


Period	Values	Computed (°F)	Observed (°F)	Bias (°F)	RMS Differences (°F)	Mean Differences (°F)
Dec	246	52.25	52.14	0.11	0.94	0.79
Jan-Mar	722	48.35	48.74	-0.39	1.60	1.23
Apr-Jun	724	51.37	51.24	0.13	1.35	1.09
Jul-Sep	786	53.20	52.87	0.34	0.85	0.67
Oct-Dec	734	53.63	53.43	0.19	0.99	0.81
Average Year	2966	51.68	51.60	0.07	1.23	0.94

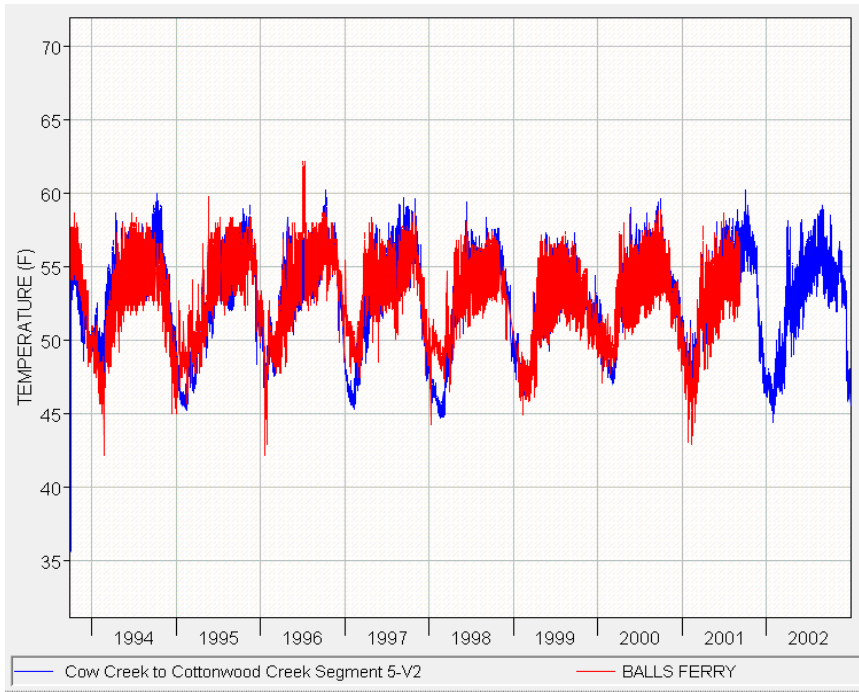

1
2
3
4

Figure 6B.C.24 Sacramento River at Balls Ferry Observed (red) and Computed (blue) Temperature Time Series Resulting from the Trinity-Sacramento River Validation

Appendix 6B.C: Surface Water Temperature Modeling – HEC-5Q Model Update

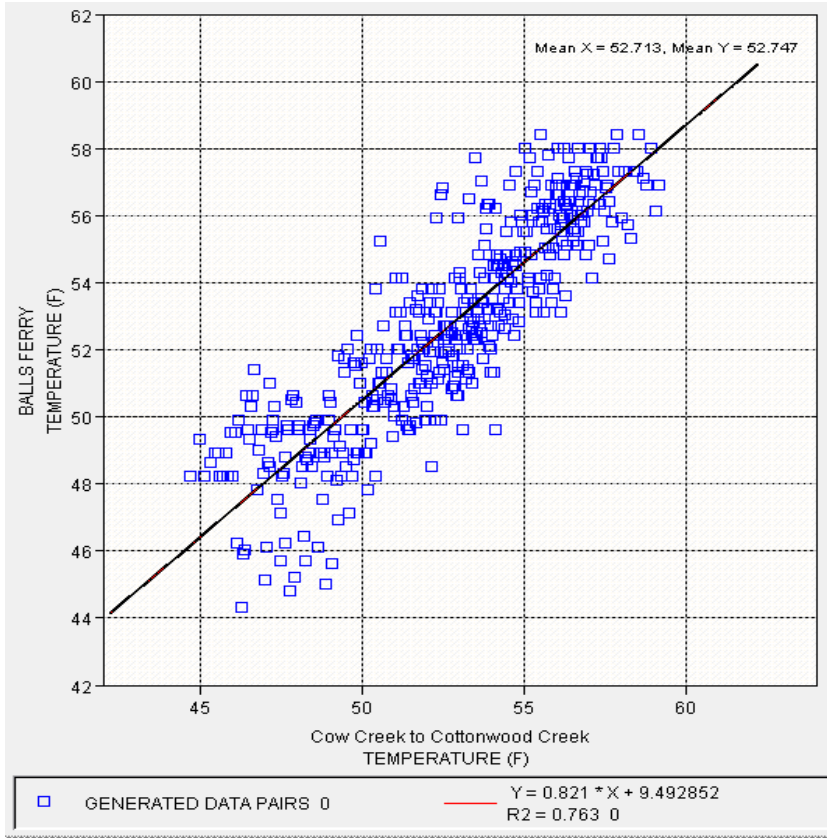


1

2 **Figure 6B.C.25 Sacramento River at Balls Ferry Observed (Y-Axis) and Computed**
 3 **(X-axis) Temperature Data Pairs Resulting from the Trinity-Sacramento River**
 4 **Validation**

5 **Table 6B.C.10 Sacramento River at Balls Ferry Computed and Observed Statistical**
 6 **Comparison**

Period	Values	Computed (°F)	Observed (°F)	Bias (°F)	RMS Differences (°F)	Mean Differences (°F)
Jan	442	48.25	49.31	-1.05	2.42	1.93
Feb	432	47.51	48.49	-0.98	2.20	1.79
Mar	496	49.42	50.25	-0.83	1.73	1.43
Apr	452	52.06	52.50	-0.44	1.74	1.41
May	472	53.08	53.34	-0.25	1.51	1.21
Jun	446	53.81	54.10	-0.29	1.48	1.17
Jul	452	54.59	54.76	-0.17	1.44	0.99
Aug	464	54.54	54.62	-0.08	1.34	1.05
Sep	426	55.23	55.08	0.15	1.20	0.97
Oct	410	55.54	54.96	0.59	1.27	0.99
Nov	392	54.50	54.06	0.44	1.08	0.85


Period	Values	Computed (°F)	Observed (°F)	Bias (°F)	RMS Differences (°F)	Mean Differences (°F)
Dec	374	51.29	51.44	-0.15	1.52	1.21
Jan-Mar	1370	48.44	49.39	-0.95	2.12	1.70
Apr-Jun	1370	52.98	53.31	-0.33	1.58	1.26
Jul-Sep	1342	54.77	54.81	-0.04	1.33	1.01
Oct-Dec	1176	53.84	53.54	0.30	1.30	1.01
Average Year	5258	52.45	52.72	-0.27	1.63	1.26

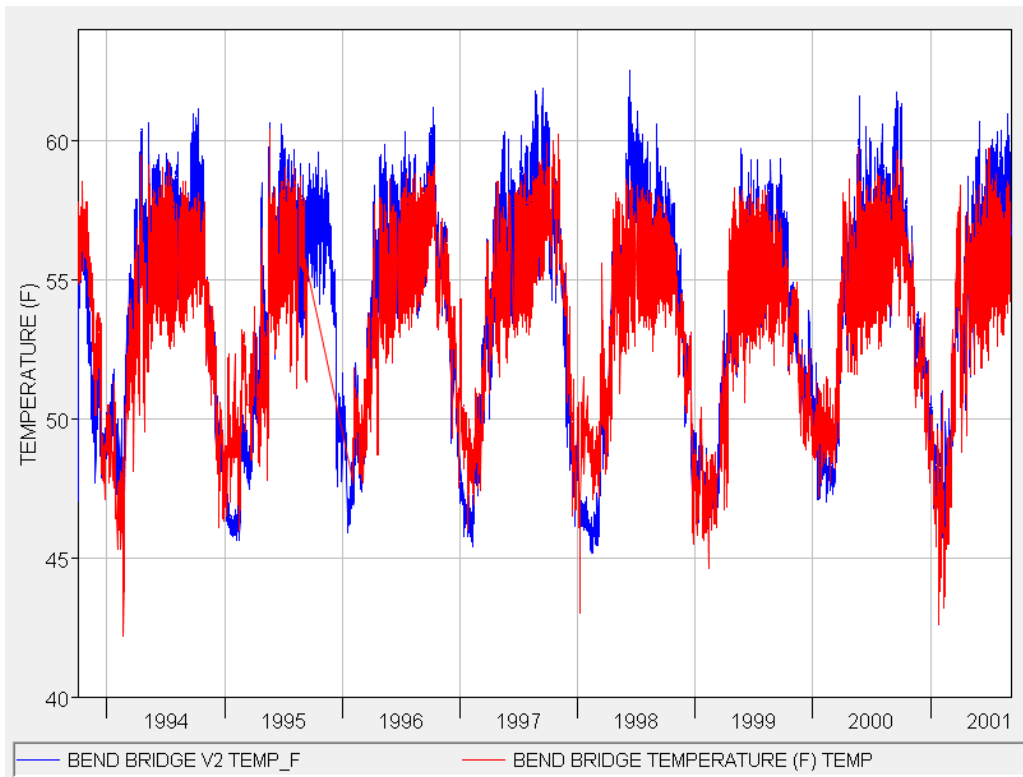

- 1
- 2
- 3
- 4

Figure 6B.C.26 Sacramento River at Bend Bridge Observed (red) and Computed (blue) Temperature Time Series Resulting from the Trinity-Sacramento River Validation

Appendix 6B.C: Surface Water Temperature Modeling – HEC-5Q Model Update

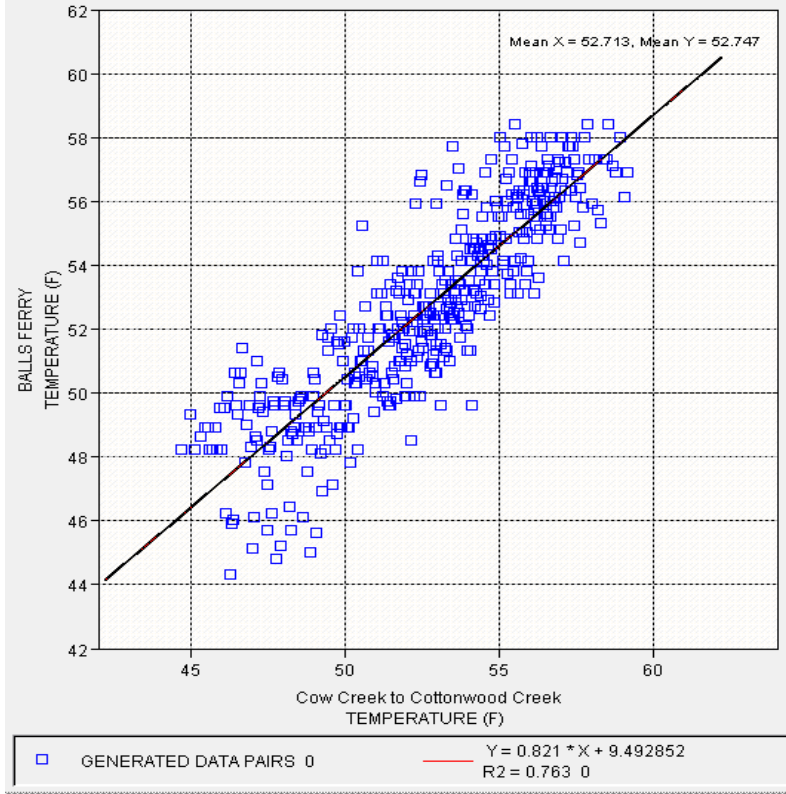

1
2
3
4


Figure 6B.C.27 Sacramento River at Bend Bridge Observed (Y-Axis) and Computed (X-axis) Temperature Data Pairs Resulting from the Trinity-Sacramento River Validation

5
6

Table 6B.C.11 Sacramento River at Balls Ferry Computed and Observed Statistical Comparison

Period	Values	Computed (°F)	Observed (°F)	Bias (°F)	RMS Differences (°F)	Mean Differences (°F)
Jan	406	47.53	48.79	-1.26	2.25	1.76
Feb	446	47.51	48.45	-0.94	1.95	1.60
Mar	472	50.40	51.08	-0.69	1.52	1.20
Apr	472	53.76	53.64	0.12	1.60	1.29
May	486	55.45	54.74	0.71	1.48	1.18
Jun	432	56.32	55.33	1.00	1.70	1.30
Jul	474	56.72	55.74	0.98	1.42	1.18
Aug	466	56.53	55.81	0.72	1.32	1.11
Sep	390	56.99	56.14	0.85	1.42	1.12
Oct	366	56.25	55.80	0.45	1.17	0.95
Nov	360	53.45	53.70	-0.25	1.16	0.90


Period	Values	Computed (°F)	Observed (°F)	Bias (°F)	RMS Differences (°F)	Mean Differences (°F)
Dec	366	50.03	50.36	-0.33	1.33	1.04
Jan-Mar	1324	48.55	49.49	-0.95	1.91	1.51
Apr-Jun	1390	55.15	54.55	0.60	1.59	1.26
Jul-Sep	1330	56.73	55.88	0.85	1.39	1.14
Oct-Dec	1092	53.24	53.29	-0.04	1.22	0.97
Average Year	5136	53.45	53.32	0.13	1.56	1.23

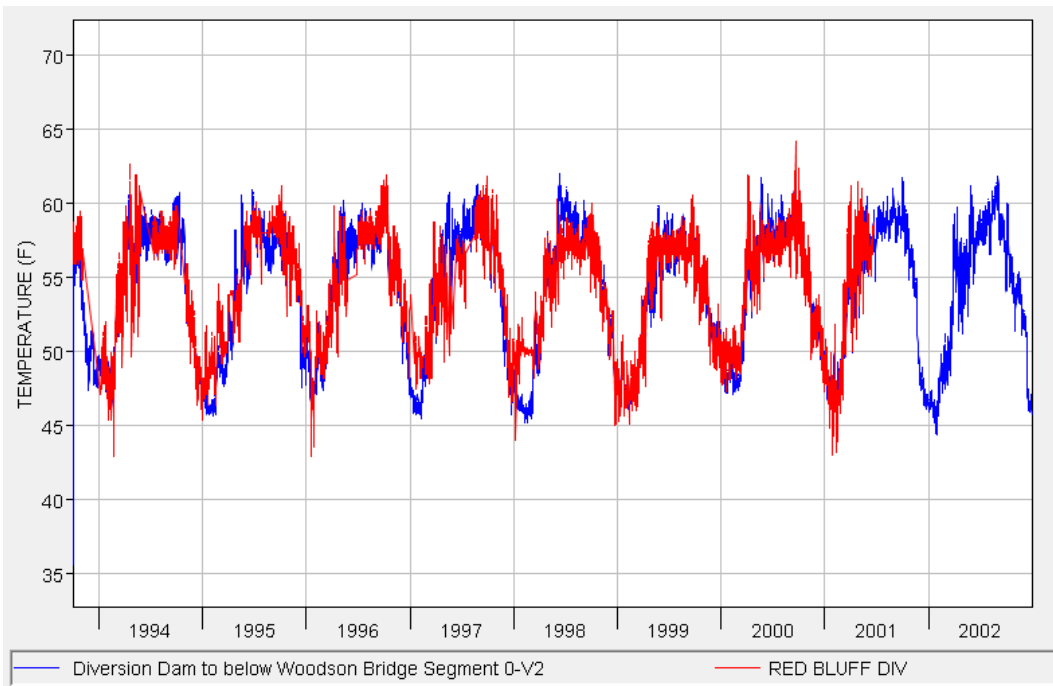

1
2
3
4

Figure 6B.C.28 Sacramento River at Red Bluff Dam Observed (red) and Computed (blue) Temperature Time Series Resulting from the Trinity-Sacramento River Validation

Appendix 6B.C: Surface Water Temperature Modeling – HEC-5Q Model Update

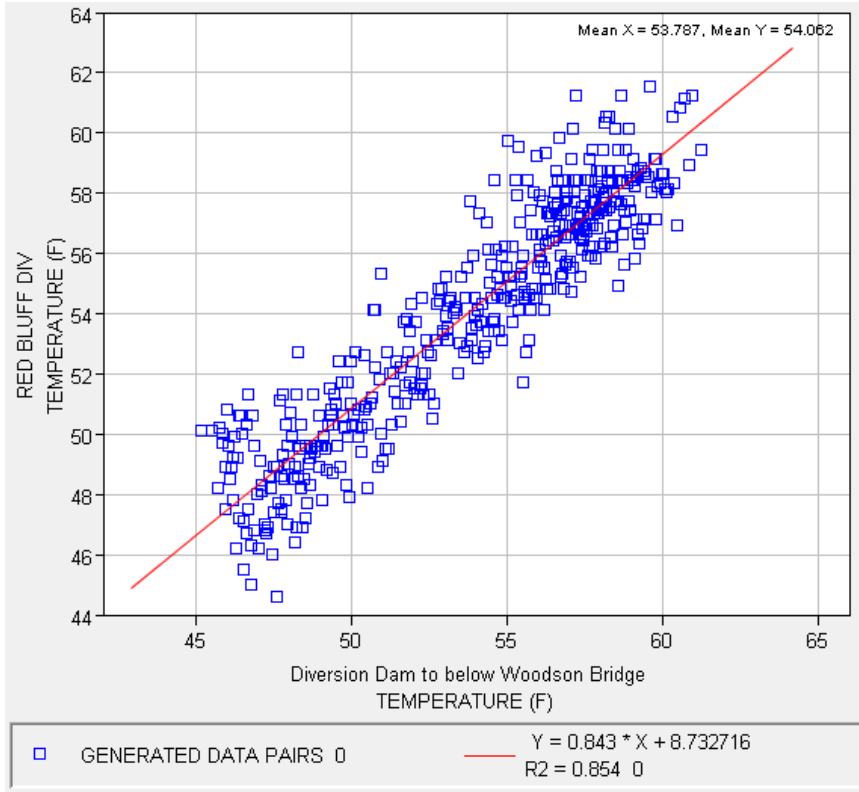

1

2 **Figure 6B.C.29 Sacramento River at Red Bluff Dam Observed (Y-Axis) and**
 3 **Computed (X-axis) Temperature Data Pairs Resulting from the Trinity-Sacramento**
 4 **River Validation**


5

6

Table 6B.C.12 Sacramento River at Red Bluff Dam Computed and Observed
Statistical Comparison


Period	Values	Computed (°F)	Observed (°F)	Bias (°F)	RMS Differences (°F)	Mean Differences (°F)
Jan	448	47.72	48.76	-1.04	2.09	1.65
Feb	434	47.63	48.95	-1.32	2.29	1.83
Mar	485	50.71	51.68	-0.97	1.71	1.38
Apr	460	54.30	54.51	-0.21	1.97	1.57
May	402	56.22	55.77	0.45	1.81	1.39
Jun	312	57.73	56.92	0.81	1.62	1.25
Jul	346	58.09	57.48	0.61	1.19	0.91
Aug	366	57.83	57.65	0.18	1.07	0.86
Sep	416	58.14	58.08	0.07	1.35	1.11
Oct	357	56.70	56.86	-0.16	1.08	0.88
Nov	408	53.97	54.22	-0.25	1.20	0.95

Period	Values	Computed (°F)	Observed (°F)	Bias (°F)	RMS Differences (°F)	Mean Differences (°F)
Dec	430	50.09	50.62	-0.54	1.55	1.20
Jan-Mar	1367	48.75	49.86	-1.11	2.04	1.61
Apr-Jun	1174	55.87	55.58	0.29	1.82	1.42
Jul-Sep	1128	58.03	57.76	0.27	1.21	0.96
Oct-Dec	1195	53.39	53.72	-0.33	1.30	1.02
Average Year	4864	53.76	54.02	-0.26	1.65	1.27

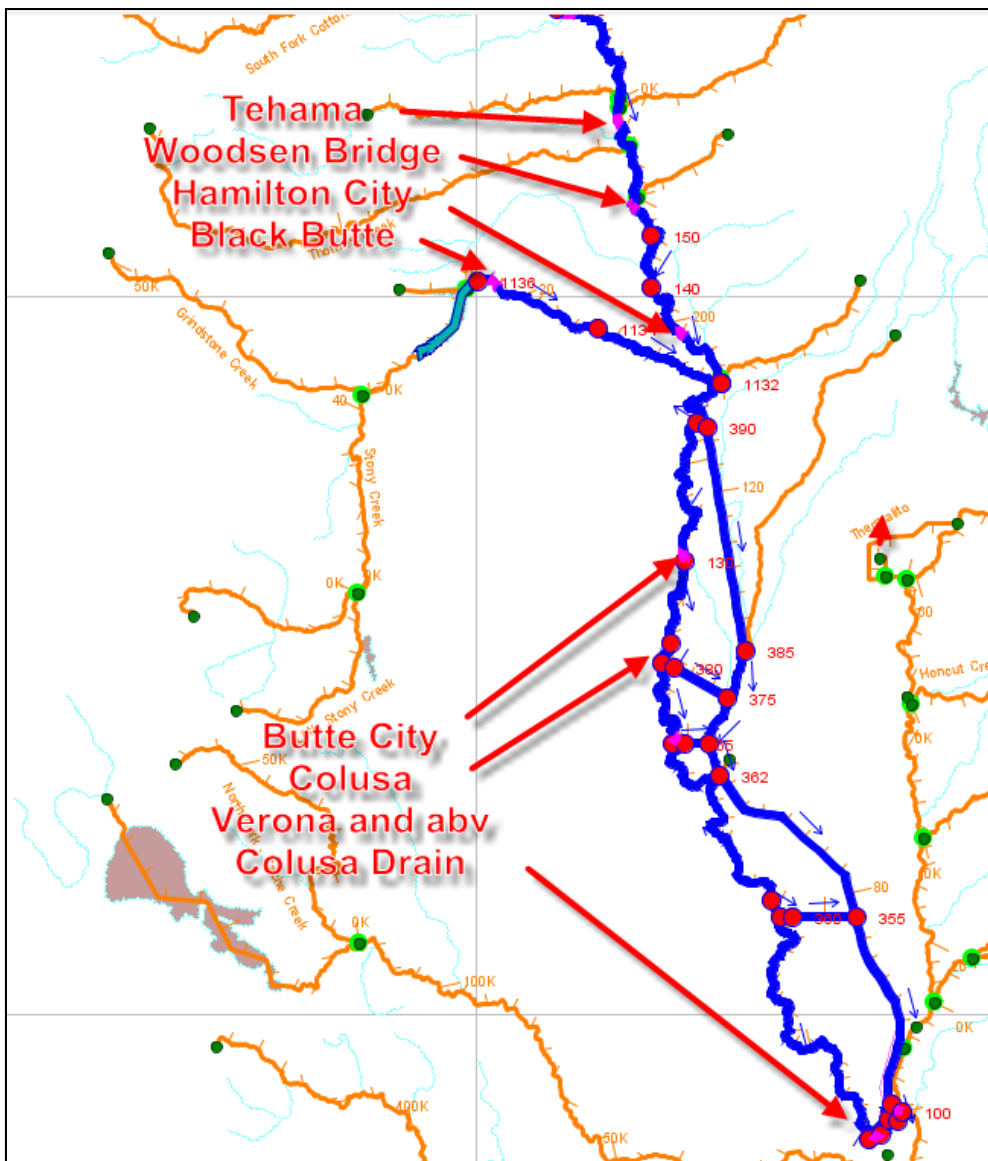


1

2 **Figure 6B.C.30 Schematic of the Trinity-Sacramento River HEC-5Q Model**
 3 **Downstream of the Tehama Colusa Canal**

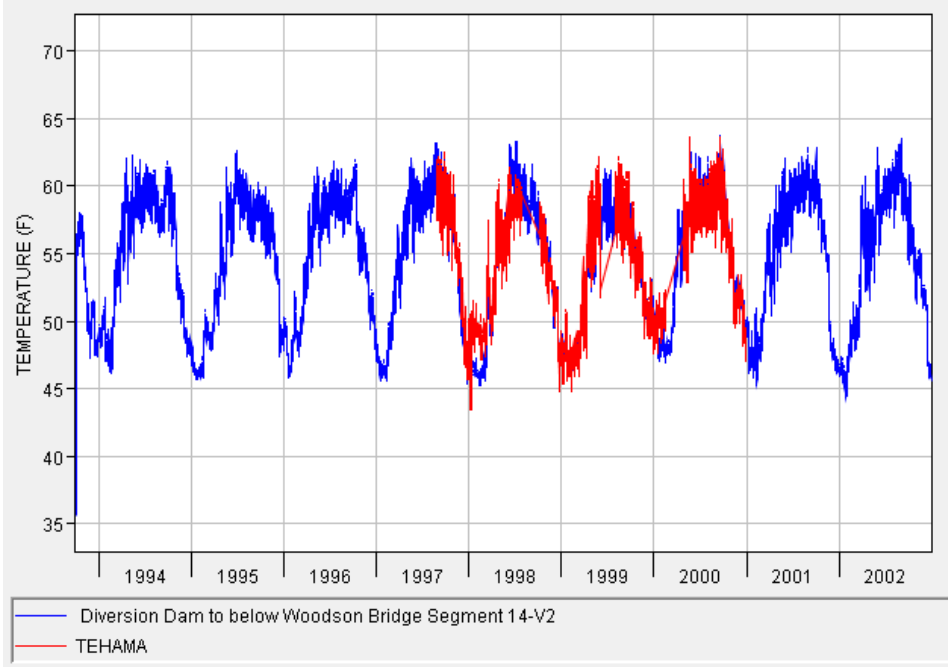

1
2
3
4

Figure 6B.C.31 Sacramento River at Tehama Colusa Canal Observed (red) and Computed (blue) temperature Time Series Resulting from the Trinity-Sacramento River Validation

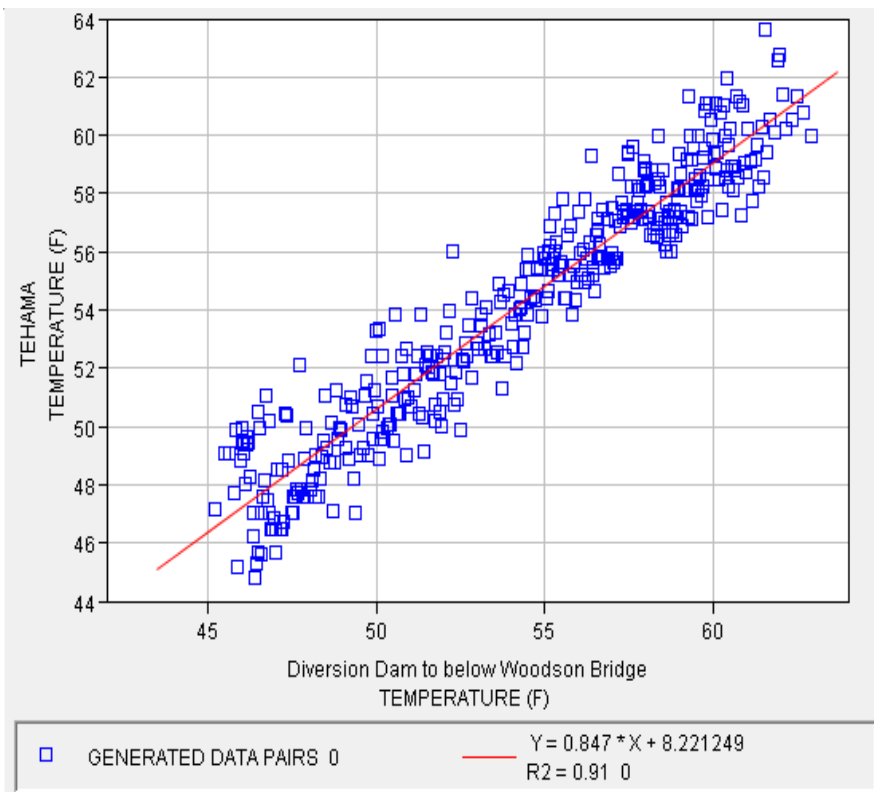


5
6
7
8

Figure 6B.C.32 Sacramento River at Tehama Colusa Canal Observed (Y-Axis) and Computed (X-axis) Temperature Data Pairs Resulting from the Trinity-Sacramento River Validation


1 **Table 6B.C.13 Sacramento River at Tehama Colusa Canal Computed and Observed**
 2 **Statistical Comparison**

Period	Values	Computed (°F)	Observed (°F)	Bias (°F)	RMS Differences (°F)	Mean Differences (°F)
Jan	448	47.72	48.76	-1.04	2.09	1.65
Feb	434	47.63	48.95	-1.32	2.29	1.83
Mar	485	50.71	51.68	-0.97	1.71	1.38
Apr	460	54.30	54.51	-0.21	1.97	1.57
May	402	56.22	55.77	0.45	1.81	1.39
Jun	312	57.73	56.92	0.81	1.62	1.25
Jul	346	58.09	57.48	0.61	1.19	0.91
Aug	366	57.83	57.65	0.18	1.07	0.86
Sep	416	58.14	58.08	0.07	1.35	1.11
Oct	357	56.70	56.86	-0.16	1.08	0.88
Nov	408	53.97	54.22	-0.25	1.20	0.95
Dec	430	50.09	50.62	-0.54	1.55	1.20
Jan-Mar	1367	48.75	49.86	-1.11	2.04	1.61
Apr-Jun	1174	55.87	55.58	0.29	1.82	1.42
Jul-Sep	1128	58.03	57.76	0.27	1.21	0.96
Oct-Dec	1195	53.39	53.72	-0.33	1.30	1.02
Average Year	4864	53.76	54.02	-0.26	1.65	1.27

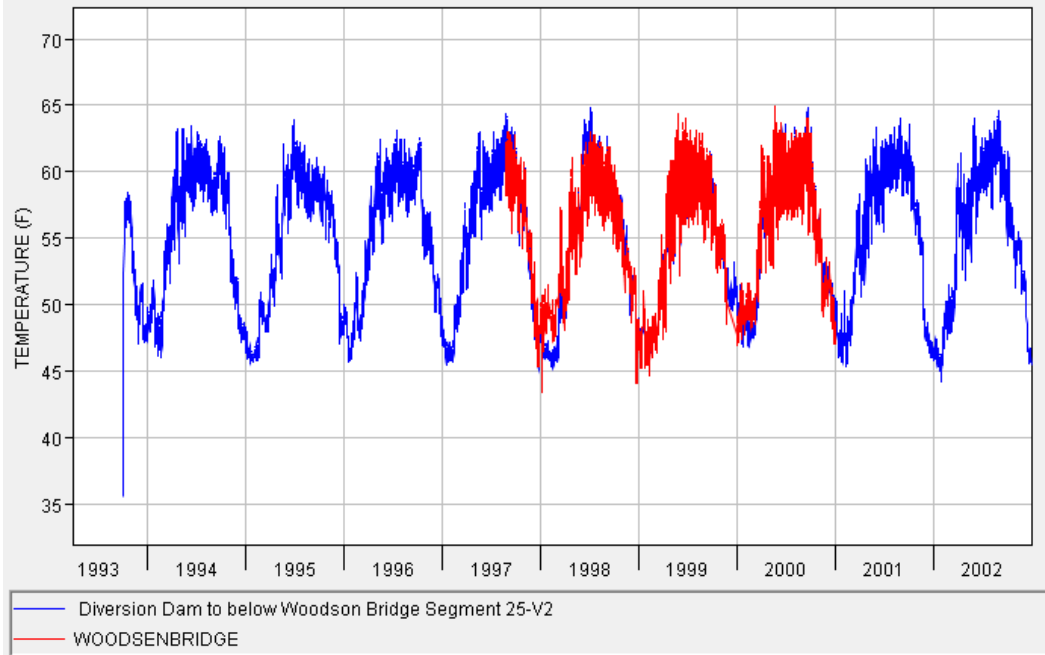

1

2 **Figure 6B.C.33 Sacramento River below Woodson Bridge Observed (red) and**
 3 **Computed (blue) Temperature Time Series Resulting from the Trinity-Sacramento**
 4 **River Validation**

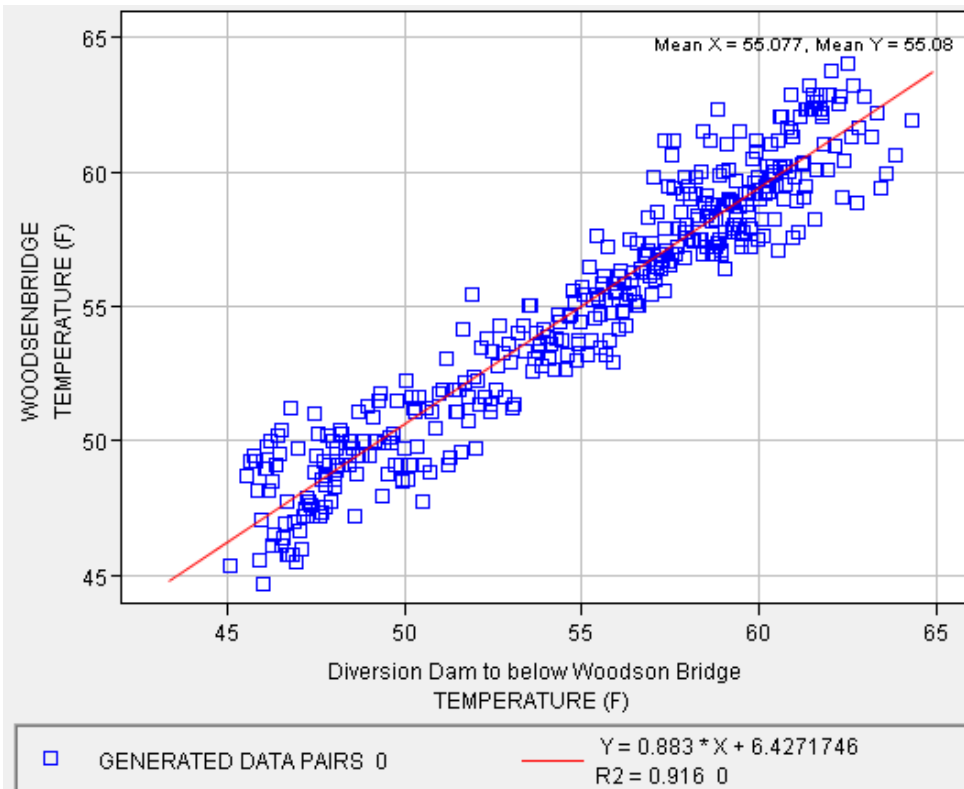


5

6 **Figure 6B.C.34 Sacramento River below Woodson Bridge Observed (Y-Axis) and**
 7 **Computed (X-axis) Temperature Data Pairs Resulting from the Trinity-Sacramento**
 8 **River Validation**


1 **Table 6B.C.14 Sacramento River below Woodson Bridge Computed and Observed**
 2 **Statistical Comparison**

Period	Values	Computed (°F)	Observed (°F)	Bias (°F)	RMS Differences (°F)	Mean Differences (°F)
Jan	279	47.71	48.54	-0.84	1.90	1.48
Feb	255	47.14	48.65	-1.51	1.96	1.62
Mar	249	50.06	51.08	-1.02	1.58	1.25
Apr	270	54.74	55.37	-0.63	1.52	1.21
May	279	57.27	57.31	-0.04	1.52	1.21
Jun	270	59.93	59.11	0.82	2.07	1.72
Jul	279	59.92	59.53	0.39	1.55	1.22
Aug	300	59.84	59.49	0.35	1.18	0.97
Sep	360	59.92	59.20	0.72	1.26	1.03
Oct	372	57.11	56.88	0.23	0.80	0.63
Nov	339	53.82	53.57	0.24	1.19	0.95
Dec	279	49.42	49.49	-0.06	1.13	0.90
Jan-Mar	783	48.27	49.38	-1.11	1.82	1.45
Apr-Jun	819	57.32	57.26	0.05	1.72	1.38
Jul-Sep	939	59.89	59.39	0.50	1.33	1.07
Oct-Dec	990	53.82	53.67	0.15	1.04	0.82
Average Year	3531	55.01	55.07	-0.06	1.48	1.15

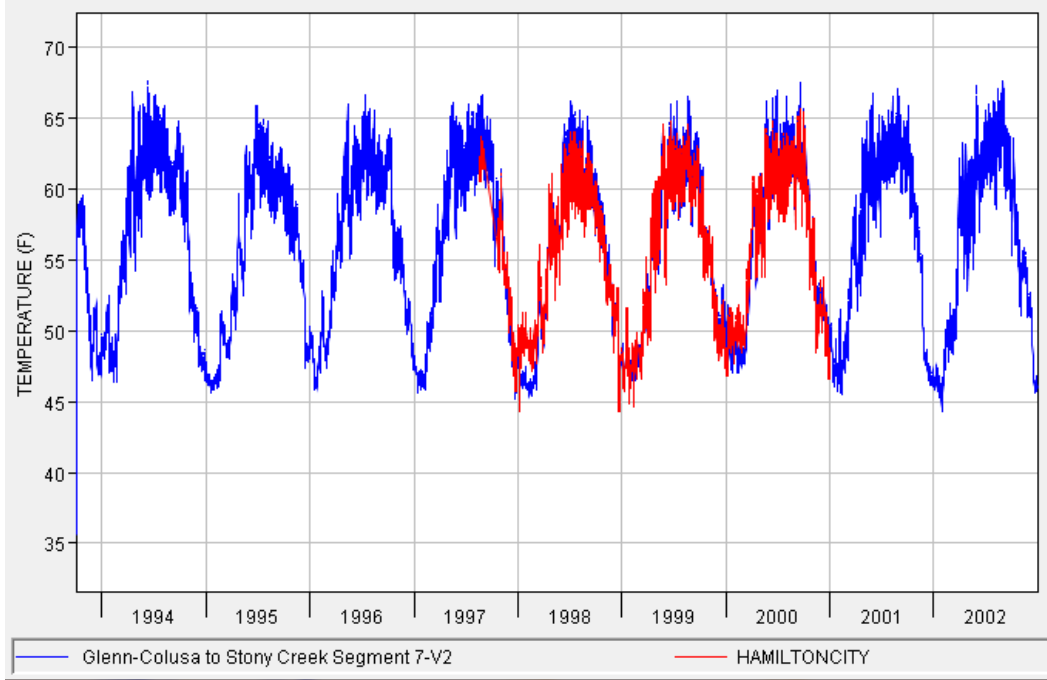

1
2
3
4

Figure 6B.C.35 Sacramento River at Hamilton City Observed (red) and Computed (blue) Temperature Time Series Resulting from the Trinity-Sacramento River Validation

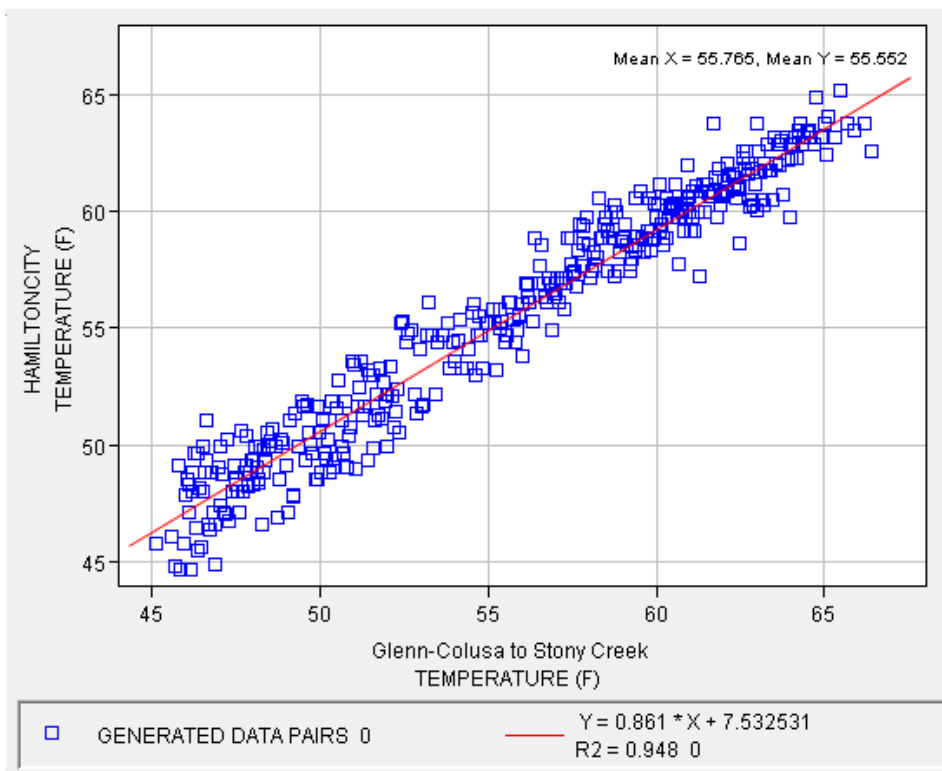


5
6
7
8

Figure 6B.C.36 Sacramento River at Hamilton City Observed (Y-Axis) as Computed (X-axis) Temperature Data Pairs Resulting from the Trinity-Sacramento River Validation


1 **Table 6B.C.15 Sacramento River at Hamilton City Computed and Observed**
 2 **Statistical Comparison**

Period	Values	Computed (°F)	Observed (°F)	Bias (°F)	RMS Differences (°F)	Mean Differences (°F)
Jan	279	47.71	48.54	-0.84	1.90	1.48
Feb	255	47.14	48.65	-1.51	1.96	1.62
Mar	249	50.06	51.08	-1.02	1.58	1.25
Apr	270	54.74	55.37	-0.63	1.52	1.21
May	279	57.27	57.31	-0.04	1.52	1.21
Jun	270	59.93	59.11	0.82	2.07	1.72
Jul	279	59.92	59.53	0.39	1.55	1.22
Aug	300	59.84	59.49	0.35	1.18	0.97
Sep	360	59.92	59.20	0.72	1.26	1.03
Oct	372	57.11	56.88	0.23	0.80	0.63
Nov	339	53.82	53.57	0.24	1.19	0.95
Dec	279	49.42	49.49	-0.06	1.13	0.90
Jan-Mar	783	48.27	49.38	-1.11	1.82	1.45
Apr-Jun	819	57.32	57.26	0.05	1.72	1.38
Jul-Sep	939	59.89	59.39	0.50	1.33	1.07
Oct-Dec	990	53.82	53.67	0.15	1.04	0.82
Average Year	3531	55.01	55.07	-0.06	1.48	1.15

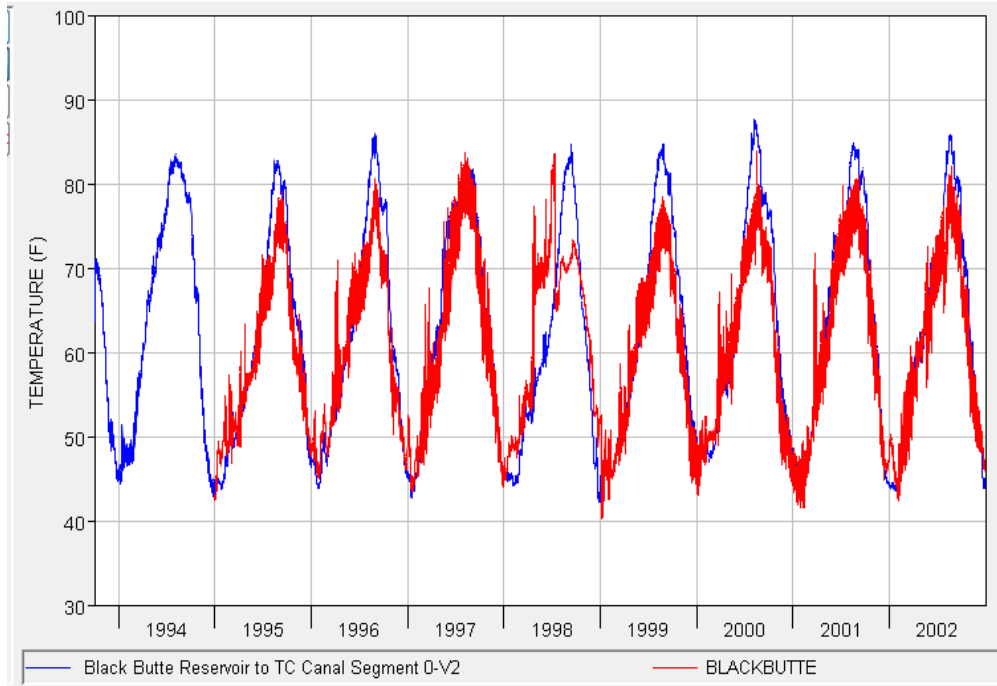

1
2
3
4

Figure 6B.C.37 Stony Creek below Black Butte Dam Observed (red) and Computed (blue) Temperature Time Series Resulting from the Trinity-Sacramento River Validation

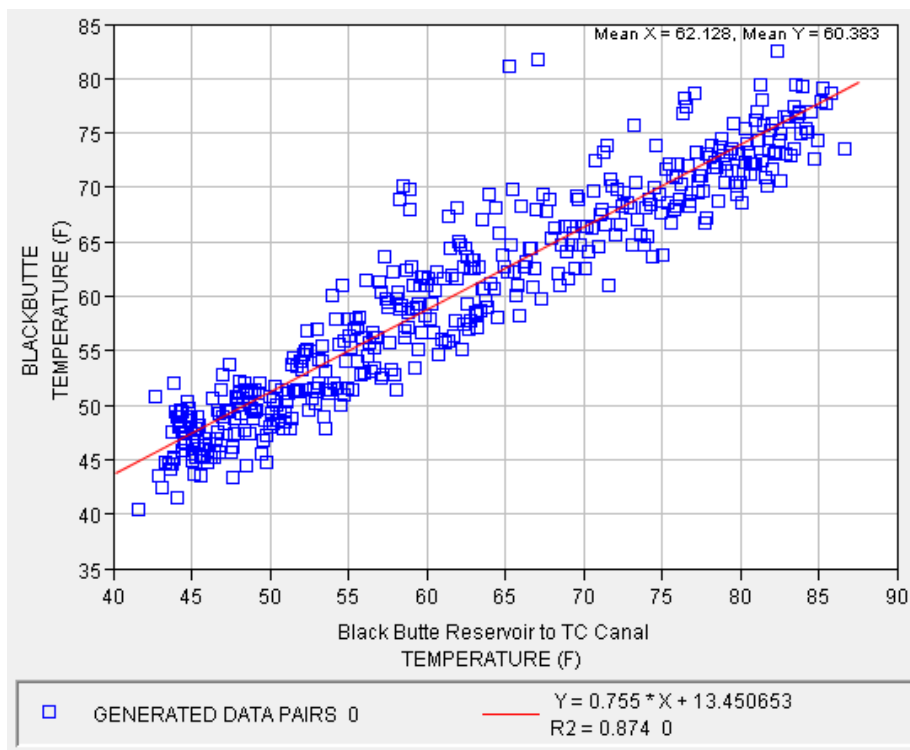


5
6
7
8

Figure 6B.C.38 Stony Creek below Black Butte Dam Observed (Y-Axis) and Computed (X-axis) Temperature Data Pairs Resulting from the Trinity-Sacramento River Validation


1 **Table 6B.C.16 Stony Creek below Black Butte Dam Computed and Observed**
 2 **Statistical Comparison**

Period	Values	Computed (°F)	Observed (°F)	Bias (°F)	RMS Differences (°F)	Mean Differences (°F)
Jan	279	47.71	48.54	-0.84	1.90	1.48
Feb	255	47.14	48.65	-1.51	1.96	1.62
Mar	249	50.06	51.08	-1.02	1.58	1.25
Apr	270	54.74	55.37	-0.63	1.52	1.21
May	279	57.27	57.31	-0.04	1.52	1.21
Jun	270	59.93	59.11	0.82	2.07	1.72
Jul	279	59.92	59.53	0.39	1.55	1.22
Aug	300	59.84	59.49	0.35	1.18	0.97
Sep	360	59.92	59.20	0.72	1.26	1.03
Oct	372	57.11	56.88	0.23	0.80	0.63
Nov	339	53.82	53.57	0.24	1.19	0.95
Dec	279	49.42	49.49	-0.06	1.13	0.90
Jan-Mar	783	48.27	49.38	-1.11	1.82	1.45
Apr-Jun	819	57.32	57.26	0.05	1.72	1.38
Jul-Sep	939	59.89	59.39	0.50	1.33	1.07
Oct-Dec	990	53.82	53.67	0.15	1.04	0.82
Average Year	3531	55.01	55.07	-0.06	1.48	1.15

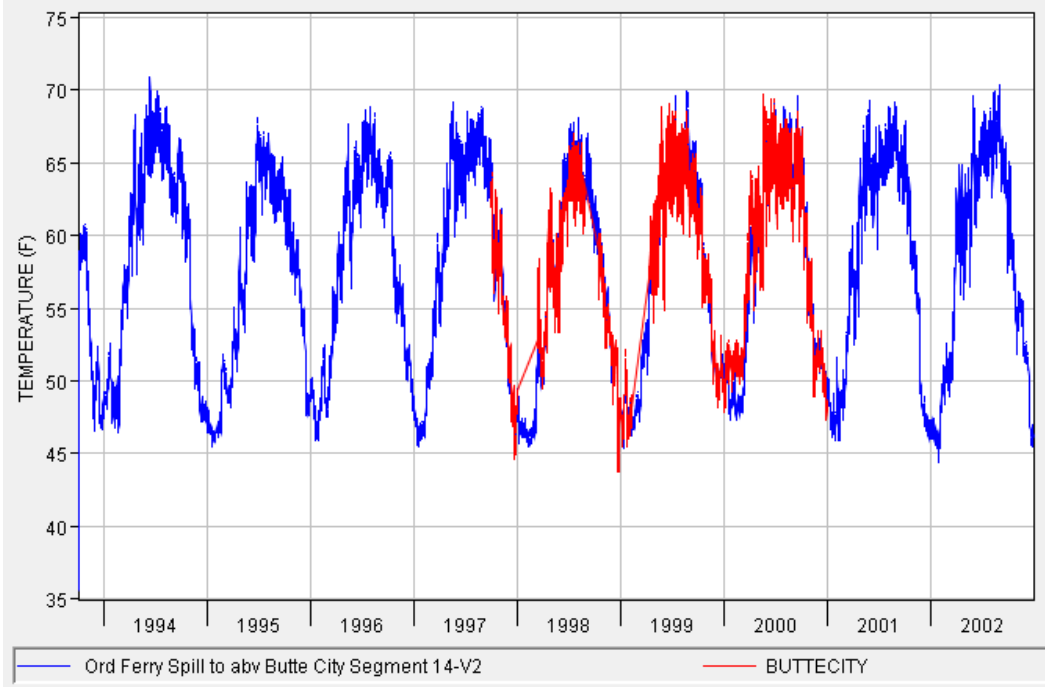

1
2
3
4

Figure 6B.C.39 Sacramento River at Butte City Observed (red) and Computed (blue) Temperature Time Series Resulting from the Trinity-Sacramento River Validation

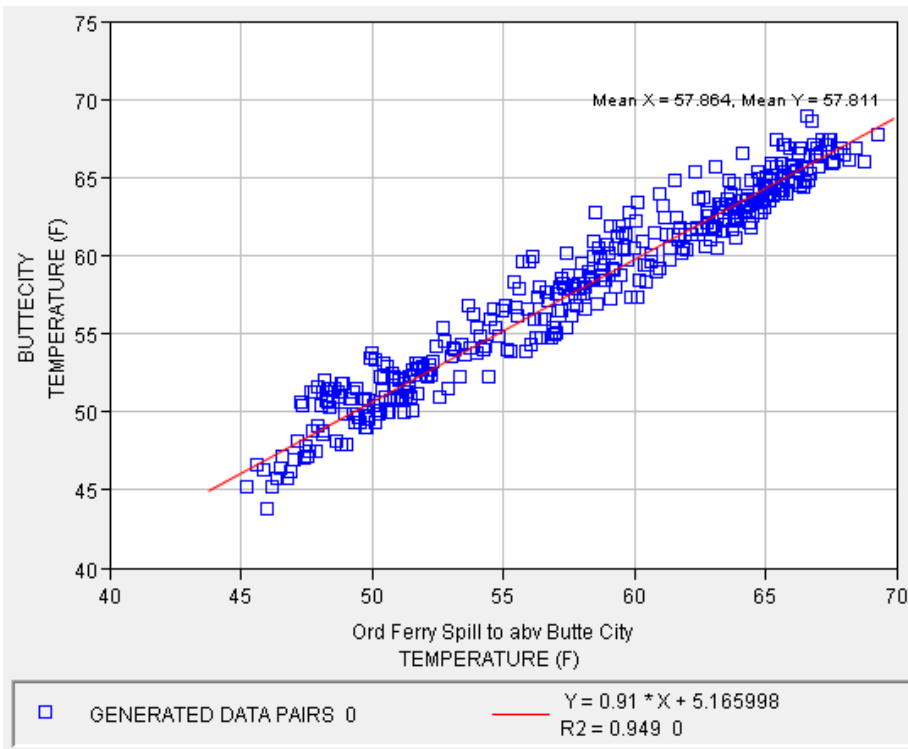


5
6
7
8

Figure 6B.C.40 Sacramento River at Butte City Observed (Y-axis) and Computed (X-axis) Temperature Data Pairs Resulting from the Trinity-Sacramento River Validation


1 **Table 6B.C.17 Sacramento River at Butte City Computed and Observed Statistical**
 2 **Comparison**

Period	Values	Computed (°F)	Observed (°F)	Bias (°F)	RMS Differences (°F)	Mean Differences (°F)
Jan	279	47.71	48.54	-0.84	1.90	1.48
Feb	255	47.14	48.65	-1.51	1.96	1.62
Mar	249	50.06	51.08	-1.02	1.58	1.25
Apr	270	54.74	55.37	-0.63	1.52	1.21
May	279	57.27	57.31	-0.04	1.52	1.21
Jun	270	59.93	59.11	0.82	2.07	1.72
Jul	279	59.92	59.53	0.39	1.55	1.22
Aug	300	59.84	59.49	0.35	1.18	0.97
Sep	360	59.92	59.20	0.72	1.26	1.03
Oct	372	57.11	56.88	0.23	0.80	0.63
Nov	339	53.82	53.57	0.24	1.19	0.95
Dec	279	49.42	49.49	-0.06	1.13	0.90
Jan-Mar	783	48.27	49.38	-1.11	1.82	1.45
Apr-Jun	819	57.32	57.26	0.05	1.72	1.38
Jul-Sep	939	59.89	59.39	0.50	1.33	1.07
Oct-Dec	990	53.82	53.67	0.15	1.04	0.82
Average Year	3531	55.01	55.07	-0.06	1.48	1.15

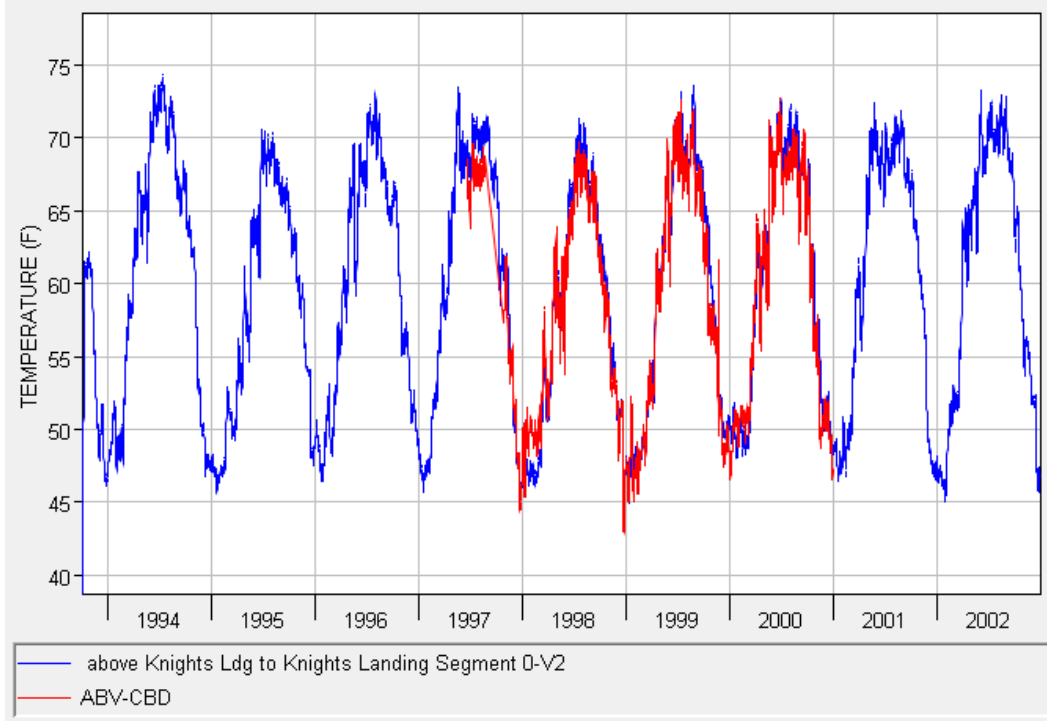

1
2
3
4

Figure 6B.C.41 Sacramento River above the Colusa Drain Observed (red) and Computed (blue) Temperature Time Series Resulting from the Trinity-Sacramento River Validation

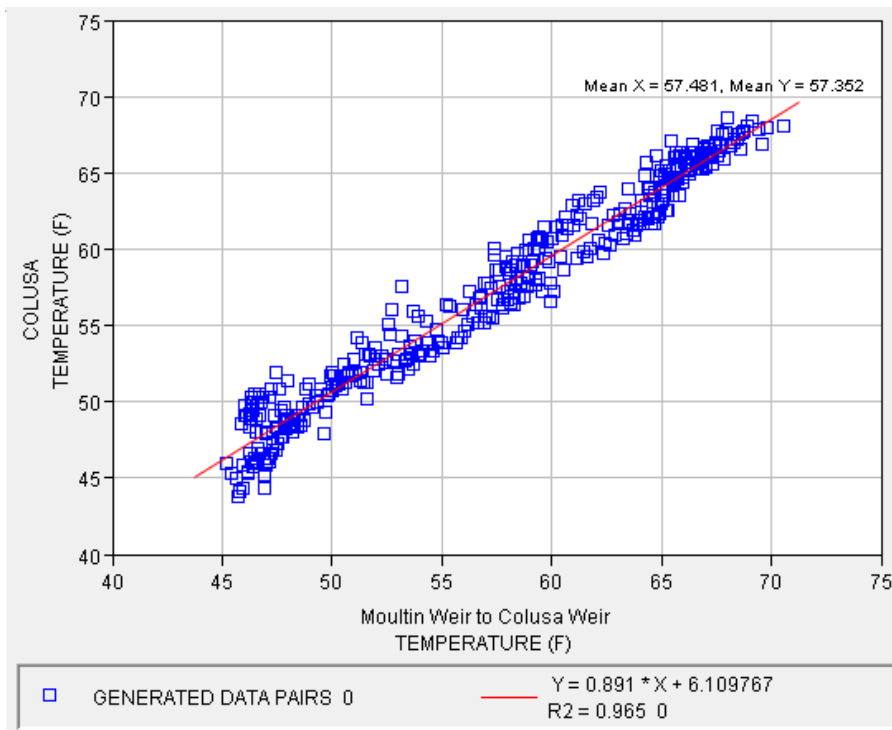

5
6
7
8


Figure 6B.C.42 Sacramento River above the Colusa Drain Observed (Y-Axis) and Computed (X-axis) Temperature Data Pairs Resulting from the Trinity-Sacramento River Validation

1 **Table 6B.C.18 Sacramento River above the Colusa Drain Computed and Observed**
 2 **Statistical Comparison**

Period	Values	Computed (°F)	Observed (°F)	Bias (°F)	RMS Differences (°F)	Mean Differences (°F)
Jan	279	48.27	48.70	-0.43	1.84	1.48
Feb	243	48.16	49.29	-1.13	1.72	1.41
Mar	273	51.55	52.63	-1.08	1.62	1.33
Apr	270	57.76	58.08	-0.32	1.12	0.89
May	279	62.57	62.12	0.45	1.39	1.03
Jun	303	67.25	66.42	0.83	1.49	1.27
Jul	372	69.51	67.90	1.61	1.84	1.63
Aug	342	69.61	68.08	1.53	1.80	1.54
Sep	270	67.27	65.88	1.38	1.93	1.47
Oct	288	62.42	60.14	2.28	2.93	2.39
Nov	360	55.52	54.39	1.13	2.03	1.61
Dec	372	49.60	48.96	0.64	1.30	1.05
Jan-Mar	795	49.36	50.23	-0.87	1.73	1.41
Apr-Jun	852	62.71	62.37	0.34	1.35	1.07
Jul-Sep	984	68.93	67.41	1.52	1.85	1.56
Oct-Dec	1020	55.31	54.03	1.28	2.12	1.62
Average Year	3651	59.41	58.76	0.66	1.80	1.43


3 **6B.C.9 American River Model Validation**

4 Comparisons between observed temperature data and computed temperature
 5 results from the validation task for the American River are provided in this
 6 section. Figures 6B.C.43 through 6B.C.50 present geographic locations used in
 7 the HEC-5Q model and comparisons of observed and computed data at these
 8 locations. Observed results are from Reclamation, DWR, and USGS data. The
 9 results indicate overall good agreement between computed and observed data.

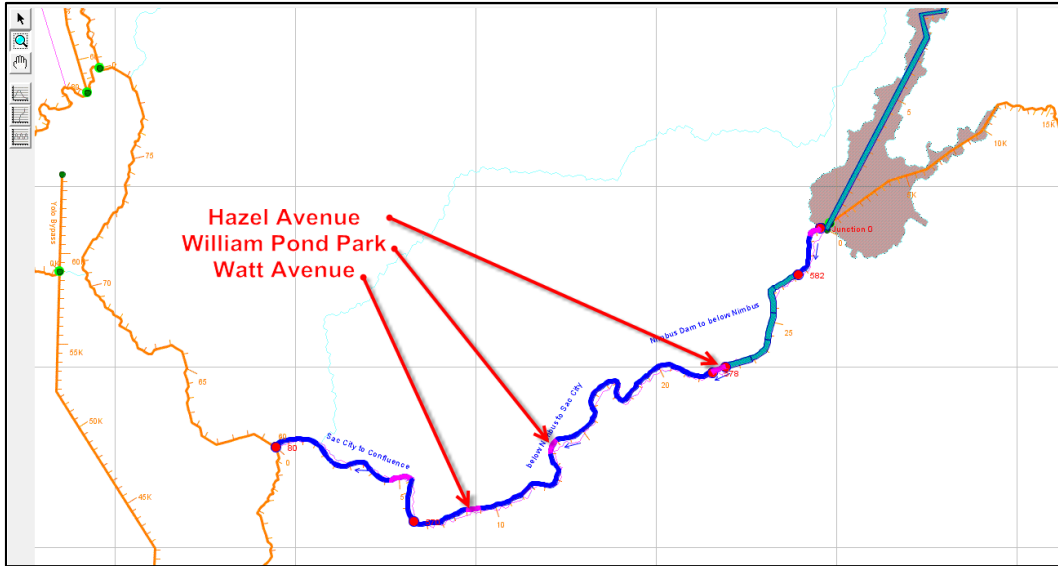


1

2 **Figure 6B.C.43 Schematic of the American River HEC-5Q Model**

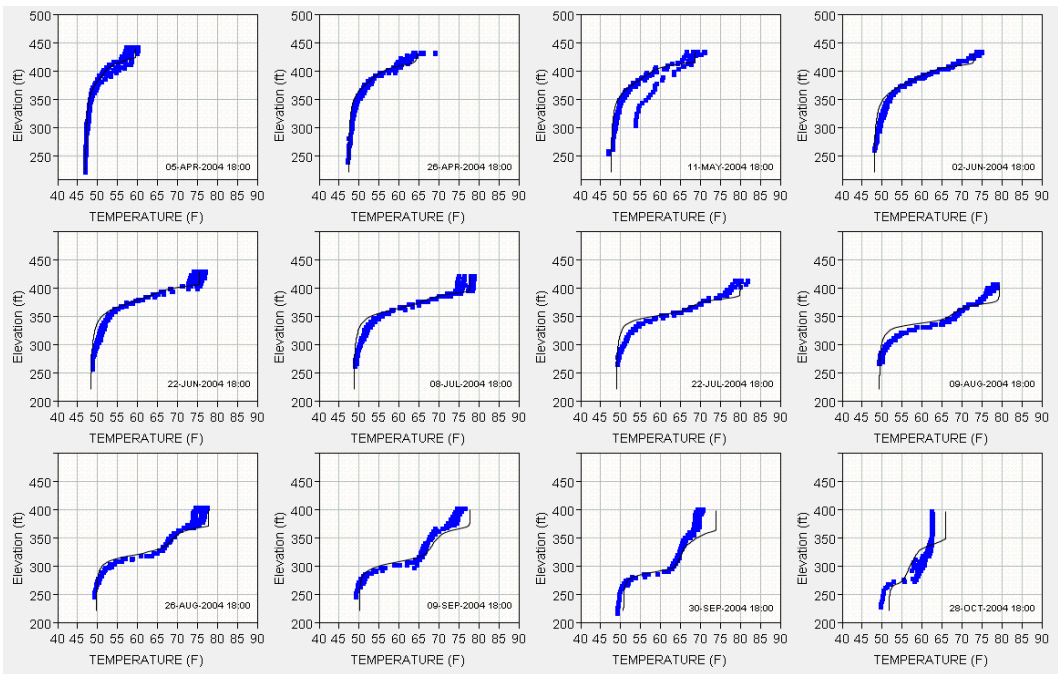

3


4 **Figure 6B.C.44 Folsom Lake Observed (blue dots) and Computed (black line)**
 5 **Temperature Profiles Resulting from the American River Validation**

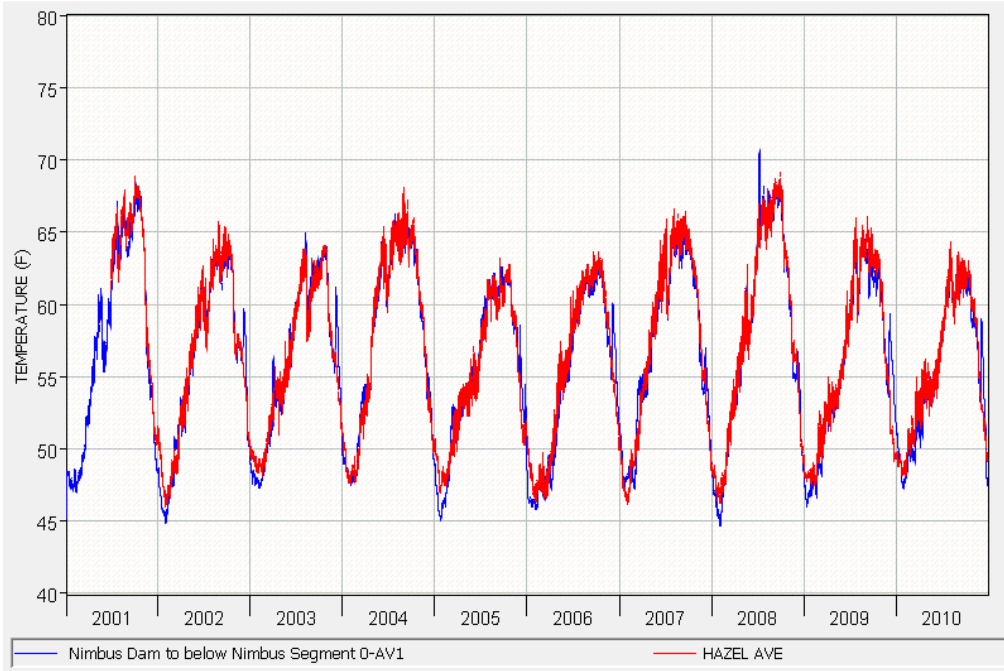

1

2 **Figure 6B.C.45 American River below Nimbus Dam Observed (red) and Computed (blue) Temperature Time Series Resulting from the American River Validation**

3

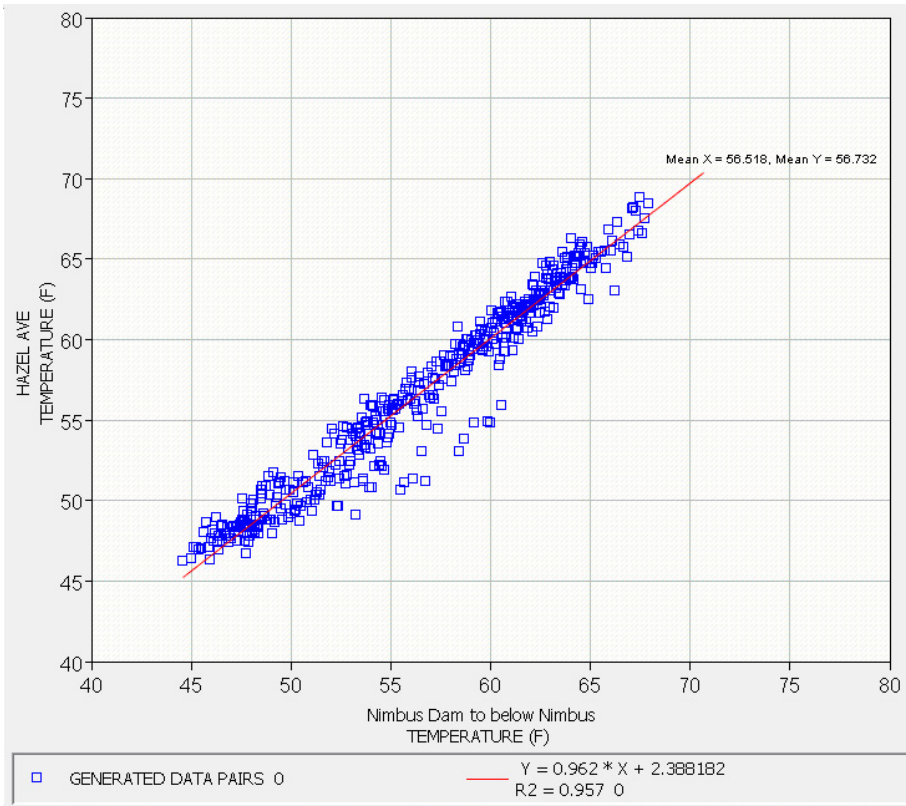


4

5 **Figure 6B.C.46 American River below Nimbus Dam Observed (Y-Axis) and**
 6 **Computed (X-axis) Temperature Data Pairs Resulting from the American River**
 7 **Validation**


1 **Table 6B.C.19 American River below Nimbus Dam Computed and Observed**
 2 **Statistical Comparison**

Period	Values	Computed (°F)	Observed (°F)	Bias (°F)	RMS Differences (°F)	Mean Differences (°F)
Jan	1108	47.54	48.53	-1.00	1.40	1.14
Feb	1016	47.71	48.21	-0.49	0.83	0.68
Mar	1116	51.03	50.71	0.32	1.29	1.05
Apr	1064	53.07	53.57	-0.50	0.96	0.78
May	1093	55.83	56.12	-0.29	0.90	0.69
Jun	1075	58.56	58.67	-0.11	0.84	0.66
Jul	1199	61.91	61.88	0.04	0.93	0.72
Aug	1192	63.08	63.08	0.00	0.89	0.68
Sep	1164	63.26	63.68	-0.42	0.99	0.82
Oct	1240	62.82	63.26	-0.44	0.66	0.56
Nov	1200	57.69	58.27	-0.58	1.05	0.88
Dec	1236	53.28	52.39	0.89	2.00	1.56
Jan-Mar	3240	48.79	49.18	-0.39	1.20	0.97
Apr-Jun	3232	55.83	56.13	-0.30	0.90	0.71
Jul-Sep	3555	62.75	62.87	-0.12	0.94	0.74
Oct-Dec	3676	57.94	57.97	-0.04	1.36	1.00
Average Year	13703	56.53	56.73	-0.20	1.12	0.86

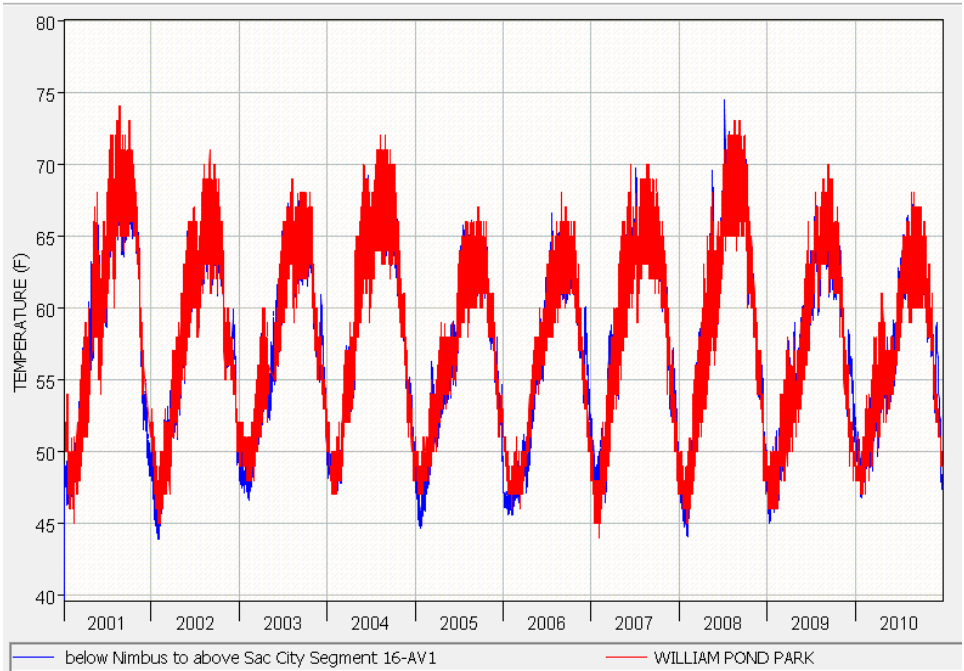

1

2 **Figure 6B.C.47 American River at William Pond Park Observed (red) and Computed (blue)**
 3 **Temperature Time Series Resulting from the American River Validation**

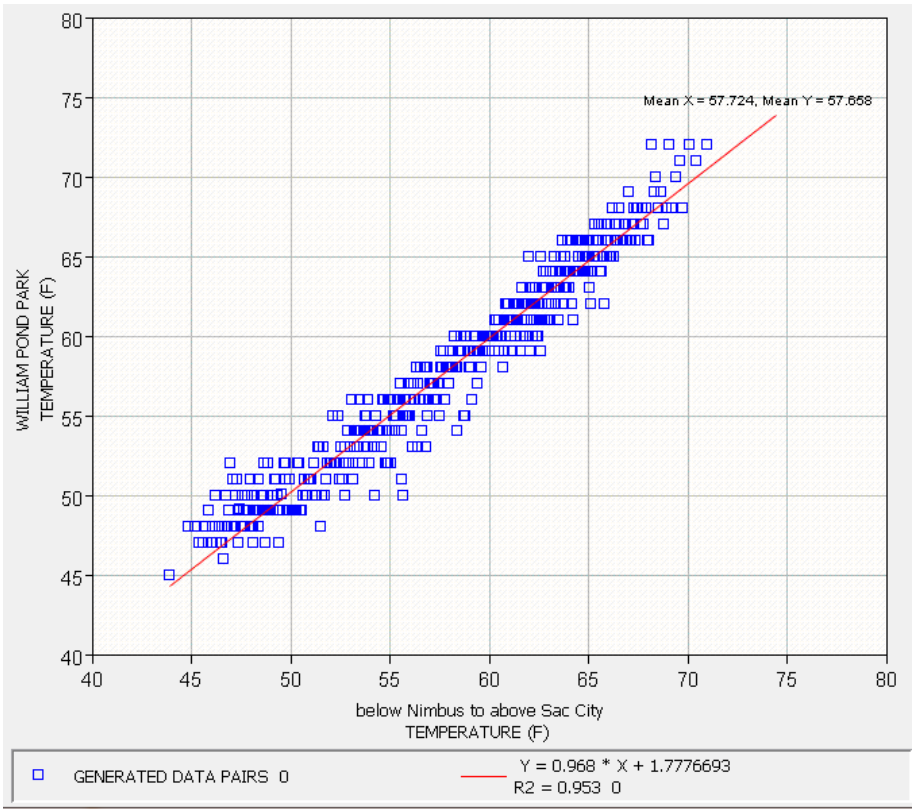

4

5 **Figure 6B.C.48 American River at William Pond Park Observed (Y-Axis) and**
 6 **Computed (X-axis) Temperature Data Pairs Resulting from the American River**
 7 **Validation**

1 **Table 6B.C.20 American River at William Pond Park Computed and Observed**
 2 **Statistical Comparison**

Period	Values	Computed (°F)	Observed (°F)	Bias (°F)	RMS Differences (°F)	Mean Differences (°F)
Jan	1198	47.78	48.68	-0.91	1.63	1.29
Feb	1121	48.51	48.75	-0.23	1.05	0.85
Mar	1219	52.35	51.80	0.54	1.39	1.12
Apr	1157	54.59	54.83	-0.24	1.16	0.92
May	1131	58.36	58.25	0.12	1.13	0.89
Jun	1196	60.62	60.27	0.34	1.07	0.84
Jul	1236	63.93	63.38	0.55	1.14	0.88
Aug	1232	65.15	64.94	0.22	1.09	0.86
Sep	1200	64.79	65.18	-0.39	1.17	0.93
Oct	1240	63.24	63.76	-0.52	0.98	0.78
Nov	1200	57.70	58.26	-0.56	1.13	0.90
Dec	1113	53.24	52.24	0.99	1.84	1.43
Jan-Mar	3538	49.58	49.78	-0.19	1.38	1.09
Apr-Jun	3484	57.88	57.81	0.08	1.12	0.88
Jul-Sep	3668	64.63	64.49	0.13	1.13	0.89
Oct-Dec	3553	58.24	58.30	-0.06	1.35	1.02
Average Year	14243	57.65	57.66	-0.01	1.25	0.97

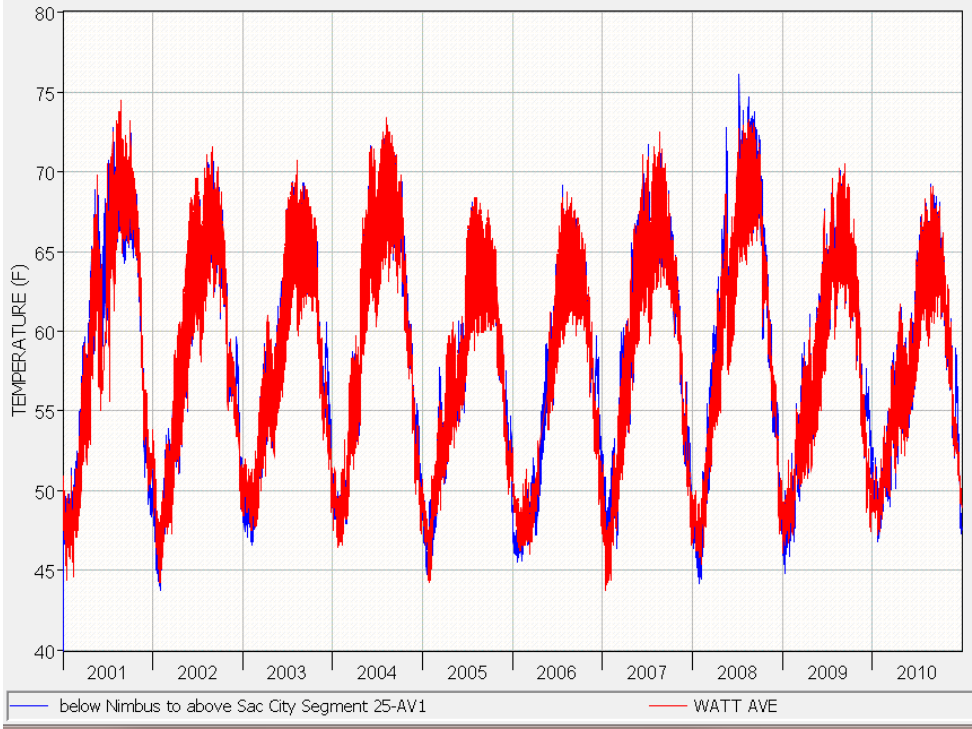


Figure 6B.C.49 American River at Watt Avenue Observed (red) and Computed (blue) Temperature Time Series Resulting from the American River Validation

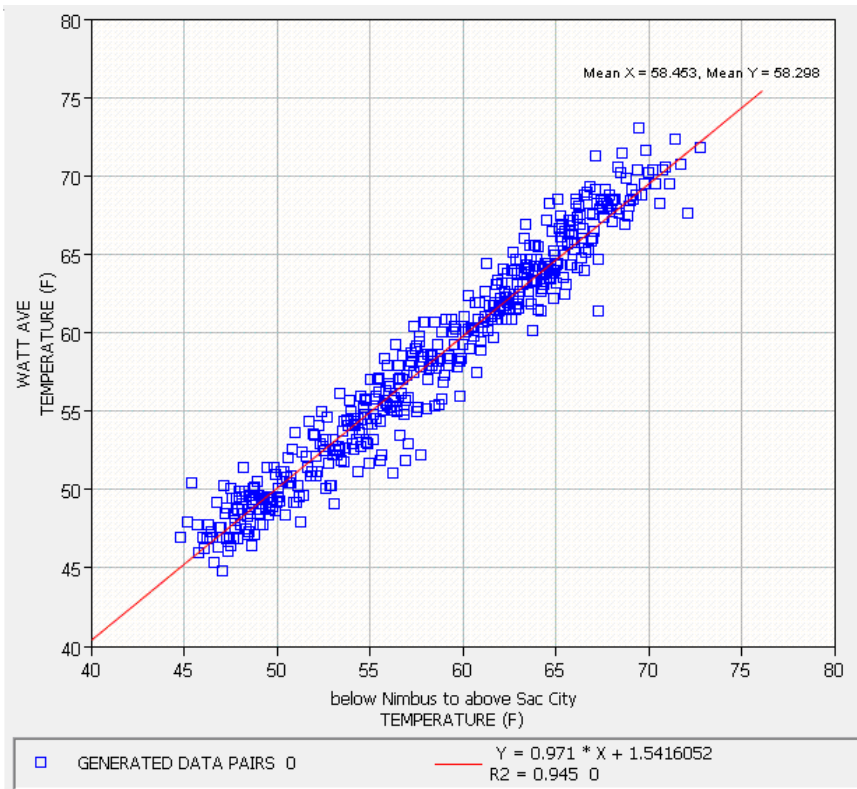


Figure 6B.C.50 American River at Watt Avenue Observed (Y-Axis) and Computed (X-axis) Temperature Data Pairs Resulting from the American River Validation


1 **Table 6B.C.21 American River at Watt Avenue Computed and Observed Statistical**
 2 **Comparison**

Period	Values	Computed (°F)	Observed (°F)	Bias (°F)	RMS Differences (°F)	Mean Differences (°F)
Jan	1223	47.91	48.48	-0.57	1.45	1.09
Feb	1128	49.14	49.11	0.02	1.02	0.83
Mar	1224	53.40	52.77	0.63	1.44	1.17
Apr	1153	55.98	55.99	0.00	1.26	1.02
May	1151	59.88	59.52	0.36	1.37	1.08
Jun	1200	62.20	61.43	0.77	1.89	1.35
Jul	1240	65.51	64.67	0.84	1.75	1.25
Aug	1236	66.64	66.42	0.22	1.40	1.16
Sep	1196	65.96	66.32	-0.36	1.38	1.14
Oct	1240	63.58	64.03	-0.46	1.01	0.84
Nov	1188	57.72	58.06	-0.35	1.05	0.83
Dec	1232	52.76	51.95	0.81	1.91	1.57
Jan-Mar	3575	50.18	50.15	0.02	1.33	1.04
Apr-Jun	3504	59.39	59.01	0.38	1.54	1.15
Jul-Sep	3672	66.04	65.80	0.24	1.52	1.18
Oct-Dec	3660	58.04	58.03	0.01	1.39	1.08
Average Year	14411	58.46	58.29	0.16	1.45	1.11

3 **6B.C.10 Trinity River Outlet Diagrams**


4 Diagrams that were used to simulate the Trinity Dam selective withdrawal
 5 procedure and the associated updates to the Trinity Dam outlets in the Trinity-
 6 Sacramento HEC-5Q model are presented in this section. Figure 6B.C.51 shows
 7 a schematic of the Trinity Dam outlets. Figure 6B.C.52 shows outlet capacity
 8 curves for the different Trinity Dam outlets. Figure 6B.C.53 shows the
 9 operational and flow vs. head (0 feet head at 1,900 feet lake elevation)
 10 characteristics of the Trinity Dam retrofitted turbine.

Appendix 6B.C: Surface Water Temperature Modeling – HEC-5Q Model Update

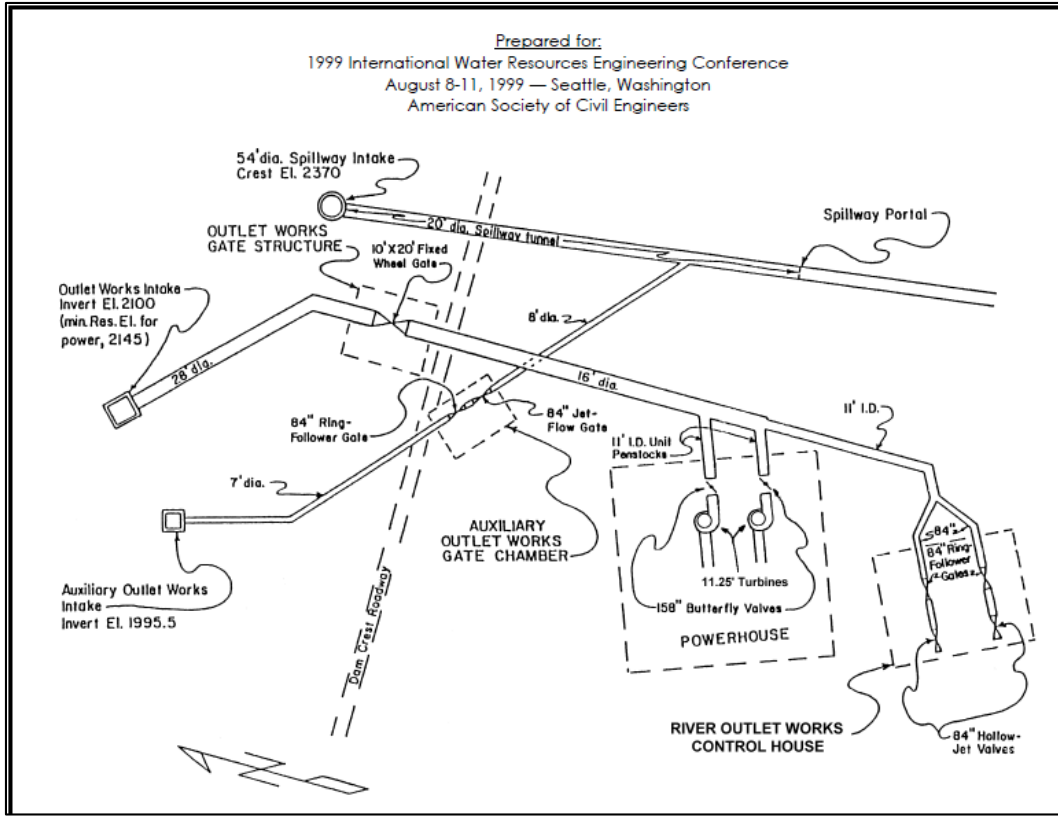

1


2 Figure 6B.C.51 Schematic of Trinity Dam Outlets (Wahl and Cohen 1999)

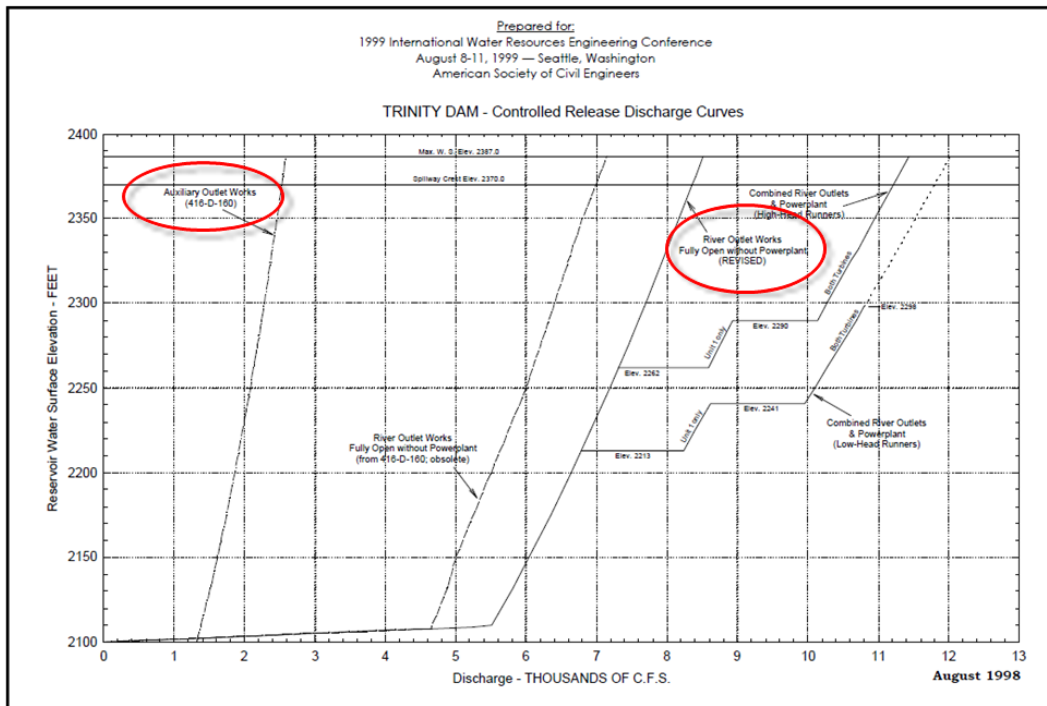

3

4 Figure 6B.C.52 Outlet Capacity Curves for Trinity Dam Outlets (Wahl and Cohen 1999)

5

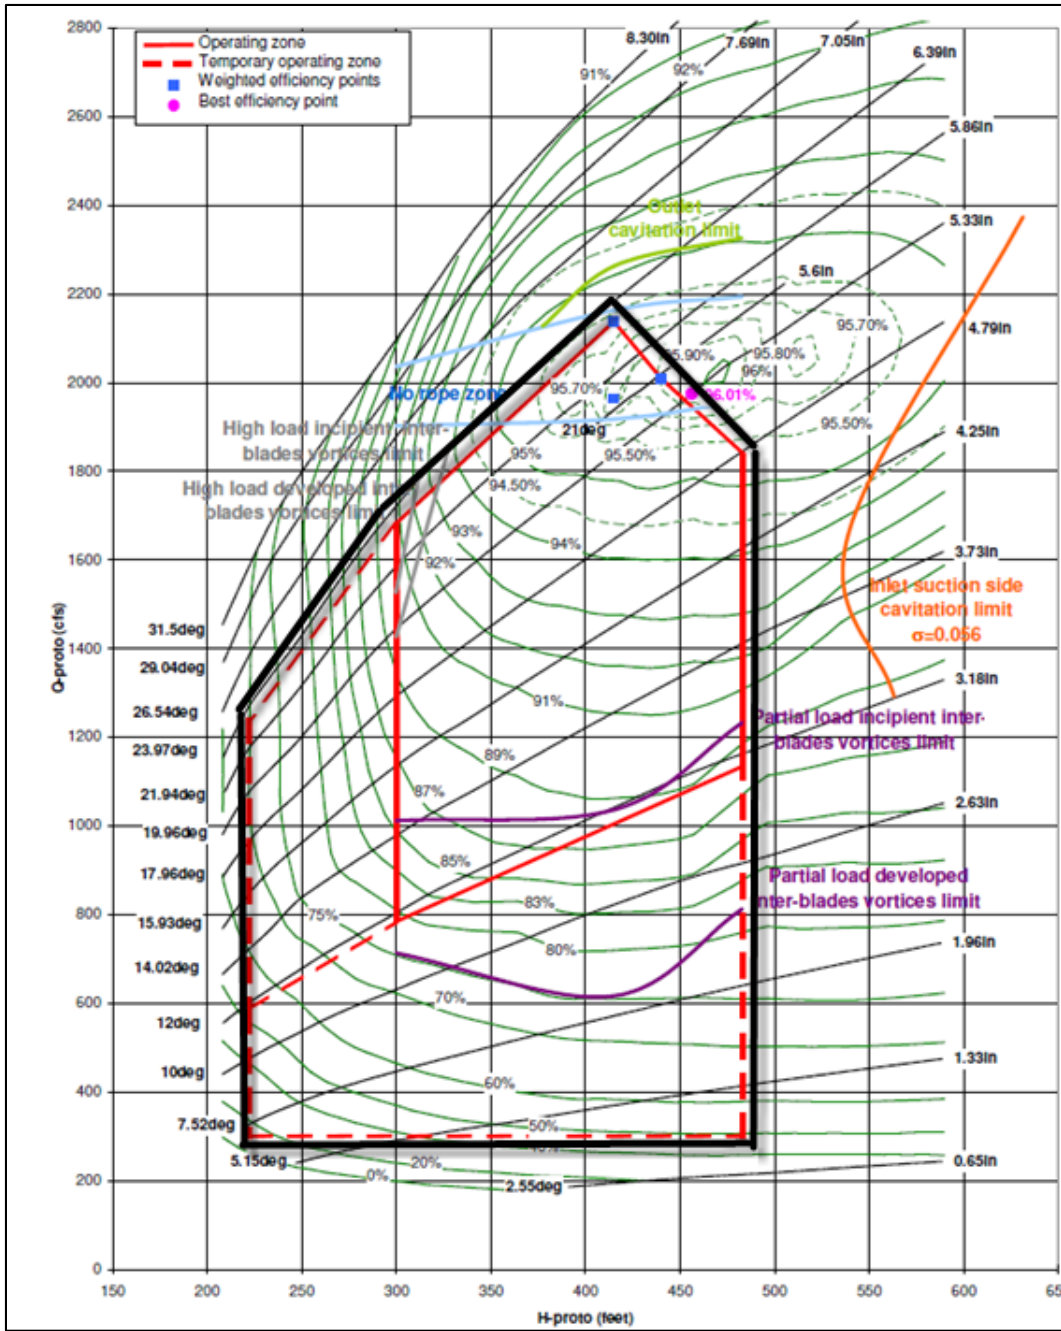

1

2 **Figure 6B.C.53 Operational and Flow Compared to Total Head (with 0 feet head at**
 3 **1,900 feet lake elevation) Characteristics of the Trinity Dam Retrofitted Turbine**

1 **6B.C.11 Shasta Release Temperature Target**
 2 **Schedules Spreadsheet Development**

3 An approach to setting Shasta Dam release temperature target schedules in
 4 accordance with the 2009 NMFS BO, current management of the temperature
 5 target locations, and the spreadsheet tool
 6 SacR_Temp_Sel_Tool_rev05_FULL_FINAL_3-3-15.xlsm are presented in this
 7 section.

8 **6B.C.11.1 Background**

9 The SWRCB Water Rights Order 90-05 and NMFS BO include water
 10 temperature criteria in Sacramento River downstream of Shasta Dam. The NMFS
 11 BO Reasonable and Prudent Alternative (RPA) I.2.1 sets forth temperature
 12 compliance percentages for the summer season at specified locations on the
 13 Sacramento River (Table 6B.C.22) for not exceeding 56⁰F at the specified
 14 location. These compliance percentages do not apply during extended drought
 15 periods.

16 **Table 6B.C.22 Compliance Percentage for Not Exceeding 56⁰F at Select Locations**
 17 **on the Sacramento River in the NMFS BO**

Location	Compliance Percentage in NMFS BO (based on 10-year moving average)
Clear Creek	95 percent of Time
Balls Ferry	85 percent of Time
Jelly's Ferry	40 percent of Time
Bend Bridge	15 percent of Time

18 Shasta Lake releases are operated to not exceed 56⁰F at the compliance locations,
 19 to the extent possible. The Sacramento River Temperature Task Group (SRTTG)
 20 meets once a month from April to October to discuss temperature compliance
 21 actions, as described in Appendix 3A.


22 Historically, initial compliance locations have been correlated to End-of-April
 23 storage, as summarized in Table 6B.C.23.

24 **Table 6B.C.23 Compliance Location Based Upon End-of-April Storage**

Compliance Location	End-of-April Storage (TAF)
Clear Creek	<3600
Balls Ferry	3600 – 4000
Jelly's Ferry	4000 – 4400
Bend Bridge	>4400

25 Figure 6B.C.54 shows the temperature compliance from 1996 to 2014 based on
 26 monthly Sacramento River Temperature Reports (Reclamation 2015). Shasta

1 Dam releases were operated under SWRCB Water Rights Order 90-05 during this
 2 entire time period. Operations under the NMFS BO were initiated in 2009.

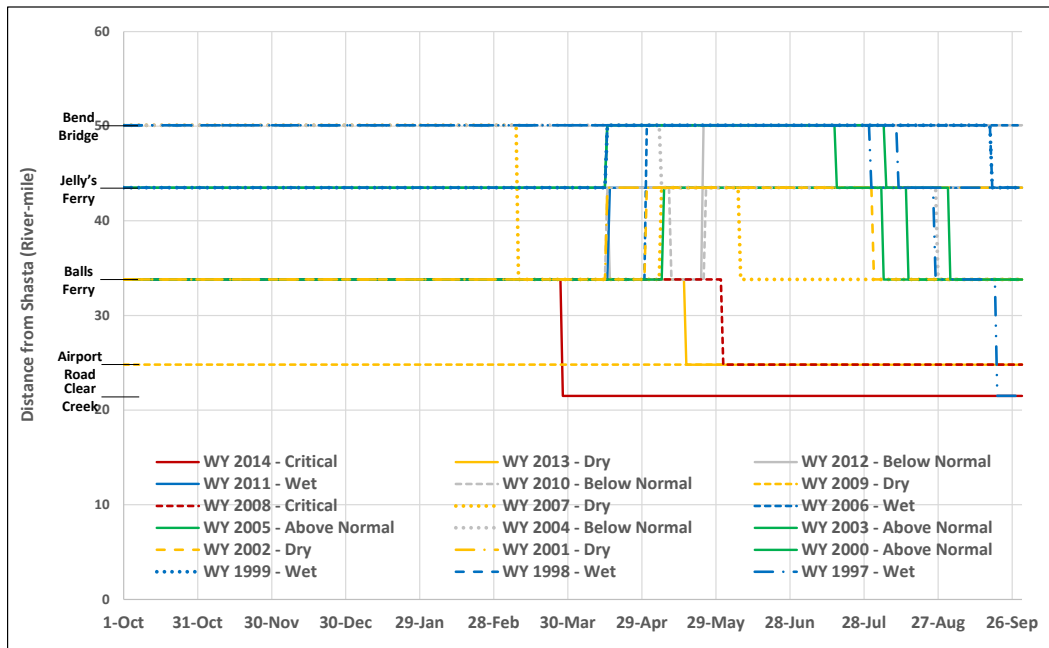

3
 4 **Figure 6B.C.54 Temperature Compliance Locations from 1996 through 2014**

5 As shown in Figure 6B.C.54, the compliance location often changed multiple
 6 times in a year as Shasta storage, meteorology, tributary, and fisheries conditions
 7 changed through the year. No specific procedure could be identified for when
 8 locations were changed. In some years, such as 2007, the location would start
 9 further downstream (Bend Bridge), then move upstream (Balls Ferry), then move
 10 downstream (Jelly’s Ferry), and then back upstream (Balls Ferry). In other years
 11 (e.g., 2004), the location would progressively move upstream.

12 Two general trends were identified. First, the compliance locations tended to be
 13 at Balls Ferry, Airport Road, and/or Clear Creek in dryer years (when Shasta Lake
 14 storage was low with less cold-water), and at Jelly’s Ferry and Bend Bridge in
 15 wetter years. Second, the compliance location tended to move closer to Shasta
 16 Dam later in the year (as the cold-water pool became more depleted and
 17 meteorological conditions became warmer). These two trends, combined with the
 18 general operations used by Reclamation to set the initial annual compliance
 19 location, were used to help develop the temperature scheduling logic described
 20 below.

21 **6B.C.11.2 Temperature Target Spreadsheet Development**

22 This section describes the development of the Sacramento River Temperature
 23 Targeting Spreadsheet SacR_Temp_Sel_Tool_rev05_FULL_FINAL_3-3-
 24 15.xlsm.

1 Shasta storage data from the CalSim II EIS No Action Alternative Q5 run dated
2 January 27, 2015 was loaded into the spreadsheet. This storage data set the
3 compliance location for each year of the CalSim II simulation period and the data
4 remain unchanged throughout the temperature schedule development. April
5 storage was chosen as the parameter from which to choose the compliance
6 location because it was specified as the indicator of cold-water pool storage in the
7 NMFS BO. April storage was divided into five tiers, each tier representing a
8 different compliance location based on Reclamation’s rule-of-thumb approach for
9 Shasta End-of-April storage shown in Table 6B.C.23. (Note that the storage tier
10 for compliance with Jelly’s Ferry is at 4,425 TAF in this procedure instead of
11 4,400 TAF.)

12 The four compliance locations (see Table 6B.C.22) were given an annual
13 temperature schedule of monthly Shasta release temperature targets. These
14 targets were developed using the following logic.

- 15 • **Step 1:** For each month individually, the difference between the modeled
16 temperature at the compliance location and the modeled temperature below
17 Shasta Dam was calculated for each year.
- 18 • **Step 2:** The difference value calculated in Step 1 that represented a specified
19 exceedance for each month was then calculated for all compliance locations.
20 This helped characterize the warming that occurred between Shasta release
21 temperatures and each compliance location. For example, September at Bend
22 Bridge was given a 5 percent exceedance. This exceedance says that only
23 5 percent of years had a September temperature difference higher than this
24 difference value (e.g. 11.2⁰F). In other words, warming that occurred
25 between Shasta and Bend Bridge in September for the previous model run was
26 11.2⁰F or lower for 95 percent of years.
- 27 • **Step 3:** The value calculated in Step 2 was then subtracted from 56⁰F and this
28 became the Shasta release temperature target for that compliance location in
29 that month. This step assumes that the Shasta release temperature target will
30 meet 56⁰F or lower at the compliance location for the exceedance percentage
31 number of years. For example, a Shasta release temperature target of 44.8⁰F
32 in September will meet 56⁰F or lower at Bend Bridge for 95 percent of years.

33 The Sacramento River HEC-5Q model was run, using the January 13, 2015
34 version delivered to Reclamation and the CalSim II data described in previously,
35 and the temperature output was loaded into the spreadsheet. The compliance
36 performance was checked by calculating the percentage of years, over the 81-year
37 simulation period, each compliance location exceeded 56⁰F for each month and
38 the difference between that percentage and the compliance percentage listed in
39 Table 6B.C.22. Then, using an initial set of exceedance percentages (described in
40 Step 2) and the latest Sacramento River HEC-5Q model code (March 3, 2015) to
41 set the new temperature schedules, the Sacramento River HEC-5Q model was re-
42 run and the temperature output reloaded in the spreadsheet. An iterative process
43 was then performed where the exceedance percentages were adjusted, the
44 Sacramento River HEC-5Q model was re-run and the temperature output was

1 reloaded, and the compliance performance was checked until the compliance
 2 performance was deemed satisfactory. The final exceedance percentages (June to
 3 December) are listed in Table 6B.C.24.

4 **Table 6B.C.24 Exceedance Percentages for June through December at the Four**
 5 **Temperature Compliance Locations**

	June	July	August	September	October	November	December
Clear Creek	75.00	50.00	15.00	5.00	25.00	40.00	50.00
Balls Ferry	75.00	50.00	15.00	5.00	25.00	40.00	50.00
Jelly's Ferry	75.00	50.00	15.00	5.00	25.00	40.00	50.00
Bend Bridge	75.00	50.00	15.00	5.00	25.00	40.00	50.00

6 January through May were not given exceedance percentages as temperature
 7 management during those months is generally not an issue. Instead, January,
 8 February, and March were given a constant temperature target of 60.8⁰F, which is
 9 the average temperature above the thermocline in Lake Shasta. Shasta Lake
 10 generally does not stratify during those months so the temperature at the top of the
 11 thermocline is assumed to be consistent through the entire depth of Shasta Lake
 12 (Rettig and Bortleson 1983). April and May were given a constant temperature of
 13 53.6⁰F, which is the average temperature below the thermocline in Shasta Lake.
 14 Stratification starts to occur in April and May and it is assumed that there is
 15 enough storage in Shasta Lake to conserve the cold-water pool. The final Shasta
 16 release temperature targets used in the spreadsheet for each compliance location
 17 are shown in Table 6B.C.25.


18 **Table 6B.C.25 Final Shasta Lake Release Temperature Targets Used in the**
 19 **Temperature Targeting Spreadsheet**

Location	Shasta Storage (TAF)	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
None	<2000	60.8	60.8	60.8	53.6	53.6	52.6	52.6	51.8	50.8	54.6	56.0	56.2
Clear Creek	<3600	60.8	60.8	60.8	53.6	53.6	52.6	52.6	51.8	50.8	54.6	56.0	56.2
Balls Ferry	<4000	60.8	60.8	60.8	53.6	53.6	51.2	51.5	50.4	49.3	54.1	56.3	56.9
Jelly's Ferry	<4425	60.8	60.8	60.8	53.6	53.6	49.6	50.1	48.7	47.7	53.6	56.7	57.6
Bend Bridge	<9999	60.8	60.8	60.8	53.6	53.6	48.5	49.0	47.4	46.6	53.4	56.9	58.1

20 This modeling approach does not dynamically change the compliance location
 21 that in reality changes throughout the year based on the SRTTG
 22 recommendations. While the temperature release targets would not change using

1 for the year with this modeling logic, the logic recognizes that those temperature
 2 release targets will not be possible to meet in each year due to changes in Shasta
 3 Lake storage and meteorological conditions. If modeled Shasta Lake releases are
 4 lower than the temperature target, then it could be considered that the compliance
 5 location was moved downstream. In addition, if Shasta Lake releases are higher
 6 than the temperature target, then it could be considered that the compliance
 7 location was moved upstream.

8 As an example, the End-of-April Storage from the CalSim II run in Year 1940 is
 9 4,140 TAF. The compliance location is therefore set to be Jelly’s Ferry and the
 10 temperature schedule in Table 6B.C.25 is for Jelly’s Ferry. Using those
 11 temperature targets, the HEC-5Q model run produces Shasta Lake outflow
 12 temperatures that do not meet those temperature targets and thus result in
 13 temperatures that do not meet 56°F at Jelly’s Ferry, due to Shasta Lake storage
 14 and downstream meteorological conditions. For instance, in July the Shasta Lake
 15 outflow was 48.6°F, even though the release target was 50.1°F. This is because
 16 Shasta Lake storage was still relatively high to preserve more cold water in the
 17 reservoir pool and meteorological conditions were cooler than were typical for
 18 July. Thus the release temperature was cooler than the temperature target and as a
 19 result, 56°F was met at Bend Bridge. In September, Shasta Lake outflow was
 20 53.7°F, even though the temperature target was 47.7°F. This is because
 21 meteorological conditions were warmer than were typical for September. Thus
 22 the release temperature was warmer than the temperature target and as result,
 23 56°F could only be met at Clear Creek. A full illustration of modeled Year 1940
 24 and the compliance location changes based on Shasta release temperatures are
 25 presented on Figure 6B.C.55.

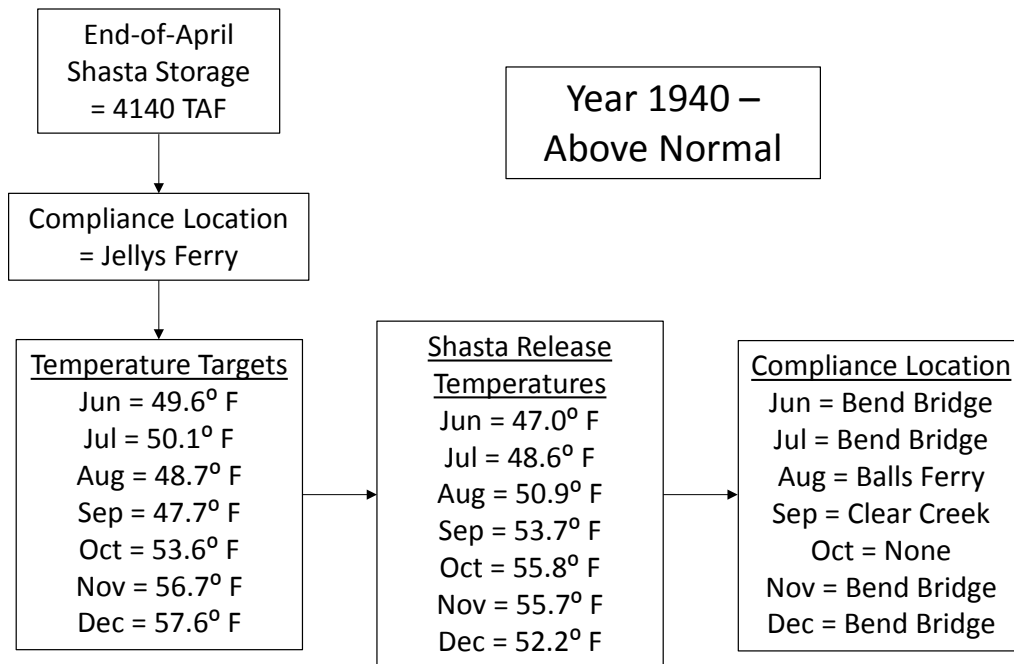

26

27 **Figure 6B.C.55 Changes in Compliance Location Based on Shasta Lake Release**
 28 **Temperatures for Year 1940**

- 1 While during all months the temperature target was set based on a compliance
- 2 location of Jelly’s Ferry, the actual compliance location changed. Thus the model
- 3 passively mimics the SRTTG changing the compliance location based on Shasta
- 4 Lake storage conditions and downstream meteorological conditions.
- 5 The chosen compliance location based on End-of-April storage and the actual
- 6 compliance location achieved over the 81-year simulation period are shown on
- 7 Figure 6B.C.56.

Appendix 6B.C: Surface Water Temperature Modeling – HEC-5Q Model Update

Year	WYT	Target	May	June	July	August	September	October	November	December
1922	AN	Jellys Ferry	Clear Creek	None	None	None	None	None	Bend Bridge	Bend Bridge
1923	BN	Clear Creek	Bend Bridge	Jellys Ferry	None	None	None	None	Bend Bridge	Bend Bridge
1924	C	Clear Creek	Clear Creek	None	Balls Ferry	None	None	None	Bend Bridge	Bend Bridge
1925	D	Balls Ferry	Bend Bridge	Bend Bridge	Bend Bridge	Jellys Ferry	Balls Ferry	Jellys Ferry	Bend Bridge	Bend Bridge
1926	D	Balls Ferry	Bend Bridge	Bend Bridge	Jellys Ferry	None	None	None	Bend Bridge	Bend Bridge
1927	W	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge	Jellys Ferry	Bend Bridge	Bend Bridge	Bend Bridge
1928	AN	Bend Bridge	Jellys Ferry	Bend Bridge	Bend Bridge	Jellys Ferry	Clear Creek	None	Bend Bridge	Bend Bridge
1929	C	Clear Creek	Bend Bridge	Jellys Ferry	Balls Ferry	None	None	None	Bend Bridge	Bend Bridge
1930	D	Clear Creek	Jellys Ferry	Jellys Ferry	Balls Ferry	None	None	None	Bend Bridge	Bend Bridge
1931	C	None	Jellys Ferry	Clear Creek	None	None	None	None	Bend Bridge	Bend Bridge
1932	D	None	Balls Ferry	Clear Creek	None	None	None	None	Bend Bridge	Bend Bridge
1933	C	None	Jellys Ferry	Clear Creek	None	None	None	None	Bend Bridge	Bend Bridge
1934	C	None	Jellys Ferry	Clear Creek	None	None	None	None	Bend Bridge	Bend Bridge
1935	BN	Clear Creek	Balls Ferry	Jellys Ferry	Balls Ferry	None	None	None	Bend Bridge	Bend Bridge
1936	BN	Balls Ferry	Bend Bridge	Bend Bridge	Bend Bridge	Balls Ferry	Clear Creek	Clear Creek	Bend Bridge	Bend Bridge
1937	BN	Balls Ferry	Balls Ferry	Jellys Ferry	Balls Ferry	Balls Ferry	None	Clear Creek	Bend Bridge	Bend Bridge
1938	W	Jellys Ferry	Bend Bridge	Balls Ferry	Balls Ferry	Jellys Ferry	Jellys Ferry	Balls Ferry	Bend Bridge	Bend Bridge
1939	D	Clear Creek	Bend Bridge	Bend Bridge	Jellys Ferry	None	None	None	Bend Bridge	Bend Bridge
1940	AN	Jellys Ferry	Jellys Ferry	Bend Bridge	Bend Bridge	Balls Ferry	Clear Creek	None	Bend Bridge	Bend Bridge
1941	W	Bend Bridge	Bend Bridge	Bend Bridge	Jellys Ferry	Jellys Ferry	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge
1942	W	Jellys Ferry	Bend Bridge	Jellys Ferry	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge
1943	W	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge	Balls Ferry	Bend Bridge	Bend Bridge
1944	D	Clear Creek	Jellys Ferry	Bend Bridge	Jellys Ferry	Clear Creek	None	None	Bend Bridge	Bend Bridge
1945	BN	Balls Ferry	Bend Bridge	Bend Bridge	Bend Bridge	Jellys Ferry	Balls Ferry	Bend Bridge	Bend Bridge	Bend Bridge
1946	BN	Jellys Ferry	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge	Jellys Ferry	Clear Creek	Bend Bridge	Bend Bridge
1947	D	Clear Creek	Bend Bridge	Bend Bridge	Jellys Ferry	None	None	None	Bend Bridge	Bend Bridge
1948	BN	Jellys Ferry	Jellys Ferry	Balls Ferry	Bend Bridge	Jellys Ferry	Balls Ferry	Bend Bridge	Bend Bridge	Bend Bridge
1949	D	Jellys Ferry	Bend Bridge	Bend Bridge	Bend Bridge	Jellys Ferry	Clear Creek	Clear Creek	Bend Bridge	Bend Bridge
1950	BN	Balls Ferry	Jellys Ferry	Bend Bridge	Jellys Ferry	Balls Ferry	Clear Creek	Bend Bridge	Bend Bridge	Bend Bridge
1951	AN	Jellys Ferry	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge	Jellys Ferry	Bend Bridge	Bend Bridge	Bend Bridge
1952	W	Jellys Ferry	Bend Bridge	Jellys Ferry	Jellys Ferry	Jellys Ferry	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge
1953	W	Bend Bridge	Bend Bridge	Jellys Ferry	Bend Bridge	Jellys Ferry	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge
1954	AN	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge	Jellys Ferry	Jellys Ferry	Bend Bridge	Bend Bridge	Bend Bridge
1955	D	Balls Ferry	Balls Ferry	Bend Bridge	Bend Bridge	Clear Creek	None	Jellys Ferry	Bend Bridge	Bend Bridge
1956	W	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge
1957	AN	Bend Bridge	Bend Bridge	Jellys Ferry	Bend Bridge	Jellys Ferry	Balls Ferry	Jellys Ferry	Bend Bridge	Bend Bridge
1958	W	Jellys Ferry	Balls Ferry	Balls Ferry	Jellys Ferry	Jellys Ferry	Bend Bridge	Clear Creek	Bend Bridge	Bend Bridge
1959	BN	Jellys Ferry	Bend Bridge	Bend Bridge	Jellys Ferry	Clear Creek	None	None	Bend Bridge	Bend Bridge
1960	D	Jellys Ferry	Balls Ferry	Bend Bridge	Bend Bridge	Balls Ferry	None	None	Bend Bridge	Bend Bridge
1961	D	Jellys Ferry	Bend Bridge	Bend Bridge	Bend Bridge	Jellys Ferry	Clear Creek	Balls Ferry	Bend Bridge	Bend Bridge
1962	BN	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge	Jellys Ferry	Clear Creek	Jellys Ferry	Bend Bridge	Bend Bridge
1963	W	Jellys Ferry	Balls Ferry	Jellys Ferry	Bend Bridge	Balls Ferry	Jellys Ferry	Clear Creek	Bend Bridge	Bend Bridge
1964	D	Balls Ferry	Bend Bridge	Bend Bridge	Bend Bridge	Balls Ferry	None	Clear Creek	Bend Bridge	Bend Bridge
1965	W	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge	Jellys Ferry	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge
1966	BN	Jellys Ferry	Bend Bridge	Bend Bridge	Bend Bridge	Jellys Ferry	Balls Ferry	Clear Creek	Bend Bridge	Bend Bridge
1967	W	Bend Bridge	Bend Bridge	Balls Ferry	Jellys Ferry	Balls Ferry	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge
1968	BN	Jellys Ferry	Bend Bridge	Bend Bridge	Bend Bridge	Balls Ferry	Clear Creek	Balls Ferry	Bend Bridge	Bend Bridge
1969	W	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge	Jellys Ferry	Balls Ferry	Bend Bridge	Bend Bridge	Bend Bridge
1970	W	Jellys Ferry	Bend Bridge	Bend Bridge	Bend Bridge	Jellys Ferry	Balls Ferry	Balls Ferry	Bend Bridge	Bend Bridge
1971	W	Jellys Ferry	Bend Bridge	Jellys Ferry	Bend Bridge	Balls Ferry	Jellys Ferry	Bend Bridge	Bend Bridge	Bend Bridge
1972	BN	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge	Balls Ferry	None	Bend Bridge	Bend Bridge	Bend Bridge
1973	AN	Jellys Ferry	Balls Ferry	Bend Bridge	Bend Bridge	Jellys Ferry	Jellys Ferry	Bend Bridge	Bend Bridge	Bend Bridge
1974	W	Jellys Ferry	Jellys Ferry	Jellys Ferry	Jellys Ferry	Balls Ferry	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge
1975	W	Jellys Ferry	Jellys Ferry	Jellys Ferry	Jellys Ferry	Balls Ferry	Bend Bridge	Jellys Ferry	Bend Bridge	Bend Bridge
1976	C	Balls Ferry	Bend Bridge	Jellys Ferry	Balls Ferry	None	None	Balls Ferry	Bend Bridge	Bend Bridge
1977	C	None	Jellys Ferry	Clear Creek	None	None	None	None	Bend Bridge	Bend Bridge
1978	AN	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge	Jellys Ferry	Balls Ferry	Balls Ferry	Bend Bridge	Bend Bridge
1979	BN	Balls Ferry	Balls Ferry	Bend Bridge	Jellys Ferry	Clear Creek	None	Clear Creek	Bend Bridge	Bend Bridge
1980	AN	Jellys Ferry	Bend Bridge	Bend Bridge	Bend Bridge	Jellys Ferry	Balls Ferry	Bend Bridge	Bend Bridge	Bend Bridge
1981	D	Jellys Ferry	Bend Bridge	Bend Bridge	Jellys Ferry	Clear Creek	None	None	Bend Bridge	Bend Bridge
1982	W	Jellys Ferry	Balls Ferry	Jellys Ferry	Jellys Ferry	Balls Ferry	Balls Ferry	Bend Bridge	Bend Bridge	Bend Bridge
1983	W	Jellys Ferry	Jellys Ferry	Balls Ferry	Balls Ferry	Balls Ferry	Balls Ferry	Balls Ferry	Bend Bridge	Bend Bridge
1984	W	Bend Bridge	Bend Bridge	Bend Bridge	Bend Bridge	Balls Ferry	Jellys Ferry	Clear Creek	Bend Bridge	Bend Bridge
1985	D	Balls Ferry	Bend Bridge	Bend Bridge	Jellys Ferry	Clear Creek	None	None	Bend Bridge	Bend Bridge
1986	W	Balls Ferry	Bend Bridge	Bend Bridge	Bend Bridge	Balls Ferry	Clear Creek	Clear Creek	Bend Bridge	Bend Bridge
1987	D	Clear Creek	Bend Bridge	Bend Bridge	Jellys Ferry	None	None	None	Bend Bridge	Bend Bridge
1988	C	Clear Creek	Bend Bridge	Bend Bridge	Balls Ferry	None	None	None	Bend Bridge	Bend Bridge
1989	D	Balls Ferry	Bend Bridge	Jellys Ferry	Jellys Ferry	None	None	None	Bend Bridge	Bend Bridge
1990	C	Clear Creek	Balls Ferry	Balls Ferry	Clear Creek	None	None	None	Bend Bridge	Bend Bridge
1991	C	Clear Creek	Jellys Ferry	Balls Ferry	None	None	None	None	Bend Bridge	Bend Bridge
1992	C	Clear Creek	Jellys Ferry	Clear Creek	None	None	None	None	Bend Bridge	Bend Bridge
1993	AN	Jellys Ferry	Jellys Ferry	Balls Ferry	Bend Bridge	Balls Ferry	Balls Ferry	Balls Ferry	Bend Bridge	Bend Bridge
1994	C	Clear Creek	Balls Ferry	Bend Bridge	Clear Creek	None	None	None	Bend Bridge	Bend Bridge
1995	W	Jellys Ferry	Bend Bridge	Balls Ferry	Balls Ferry	Balls Ferry	Balls Ferry	Jellys Ferry	Bend Bridge	Bend Bridge
1996	W	Jellys Ferry	Bend Bridge	Balls Ferry	Balls Ferry	Clear Creek	Clear Creek	None	Bend Bridge	Bend Bridge
1997	W	Balls Ferry	Bend Bridge	Bend Bridge	Bend Bridge	Clear Creek	None	Clear Creek	Bend Bridge	Bend Bridge
1998	W	Jellys Ferry	Bend Bridge	Balls Ferry	Balls Ferry	Balls Ferry	None	Clear Creek	Bend Bridge	Bend Bridge
1999	W	Bend Bridge	Bend Bridge	Jellys Ferry	Bend Bridge	Balls Ferry	Jellys Ferry	Balls Ferry	Bend Bridge	Bend Bridge
2000	AN	Bend Bridge	Balls Ferry	Bend Bridge	Bend Bridge	Balls Ferry	Clear Creek	None	Bend Bridge	Bend Bridge
2001	D	Balls Ferry	Bend Bridge	Bend Bridge	Balls Ferry	None	None	None	Bend Bridge	Bend Bridge
2002	D	Jellys Ferry	Bend Bridge	Bend Bridge	Bend Bridge	Balls Ferry	Clear Creek	Bend Bridge	Bend Bridge	Bend Bridge

1
2
3

Figure 6B.C.56 Simulated Compliance Location Target and Achievement for Each Year over the 81-Year CalSim II Period

1 **6B.C.11.3 Temperature Compliance Performance**

2 As shown in Table 6B.C.26, the compliance location achieved during each month
 3 for each year over the 81-year simulation period mimics the general trends
 4 described previously. During dry periods (e.g., 1985 to 1992), the compliance
 5 location generally starts out at the upstream locations Clear Creek and Balls
 6 Ferry. Over the course of each year, the compliance location moves progressively
 7 upstream.

8 Table 6B.C.26 shows the percentage of years the HEC-5Q model (using the
 9 CalSim II data described earlier and the temperature targets shown in
 10 Table 6B.C.25) met 56⁰F at each compliance location and the years short of
 11 meeting the compliance percentage.

12 **Table 6B.C.26 Compliance Performance of the Final Temperature Targets**

Location and Percentage of Years Required for Compliance	Jun	Jul	Aug	Sep	Oct	Nov	Dec
	<u>Percentage of Years 56⁰F Was Met at Each Compliance Location (N=81 Years)</u>						
Clear Creek (95 percent of years)	98	89	72	57	62	91	100
Balls Ferry (85 percent of years)	90	86	62	42	47	93	100
Jelly's Ferry (40 percent of years)	75	69	33	26	33	91	98
Bend Bridge (15 percent of years)	54	47	7	14	26	95	98
	<u>Number of Years Short of Compliance</u>						
Clear Creek (95 percent of years)	-	5	19	31	27	3	-
Balls Ferry (85 percent of years)	-	-	19	35	31	-	-
Jelly's Ferry (40 percent of years)	-	-	5	11	5	-	-
Bend Bridge (15 percent of years)	-	-	6	1	-	-	-

1 **6B.C.12 Folsom Release Temperature Target**
2 **Schedules Spreadsheet Development**

3 An approach to setting Folsom Dam release temperature target schedules for
4 temperature management on the Lower American River based on NMFS BO and
5 is an accompanying document to the spreadsheet tool
6 AmerR_Temp_Sel_Tool_rev15_FULL_FINAL_3-16-15.xlsm is presented in this
7 section.

8 **6B.C.12.1 Background**

9 The NMFS BO RPA II.2 sets forth a temperature requirement for the Lower
10 American River at the Watt Avenue Bridge to not exceed 65⁰F from May 15 to
11 October 31.

12 In order to meet the NMFS BO temperature requirement, Reclamation manages
13 Folsom Dam release temperatures based on temperature schedules set forth in
14 Appendix 2-D of the NMFS BO. These schedules set monthly temperatures at
15 Watt Avenue for Folsom Dam to operate to from May to October (temperature
16 management season) based on forecasted Folsom storage and inflow. The initial
17 temperature schedule for each year is determined based on an operations plan
18 developed by Reclamation and approved by the American River Operations
19 Group (ARG). However, these schedules are based on forecasted conditions. As
20 conditions actually happen throughout the temperature management season, due
21 to changes in Folsom Lake storage and inflow, current meteorological conditions,
22 and/or the state of fisheries in the river, the Watt Avenue temperature target
23 schedule is adjusted based on recommendations from the ARG.

24 It was possible to model the initial annual temperature target schedule for Folsom
25 Lake to operate to for the year because storage and forecasted inflow are known
26 quantities in CalSim II. However, modeling the dynamic adjustment of the Watt
27 Avenue temperature target based on current storage and meteorological
28 conditions was not going to be possible. Thus logic was developed to create a
29 temperature target selection procedure that set a specific schedule for each year
30 that remained unchanged. This logic is described in the following section.


31 **6B.C.12.2 Temperature Target Spreadsheet Development**

32 The development of the Sacramento River Temperature Targeting Spreadsheet
33 AmerR_Temp_Sel_Tool_rev15_FULL_FINAL_3-16-15.xlsm is described in this
34 section.

35 Folsom storage and inflow data from the CalSim II EIS No Action Alternative Q5
36 run dated January 27, 2015 was loaded into the spreadsheet. This CalSim II data
37 remained unchanged throughout the temperature schedule development. May
38 Folsom Storage plus June to September average inflow to Folsom (storage plus
39 inflow) was calculated in the spreadsheet. This was a simplification of the
40 forecasting approach that is used to set the actual temperature targets, as it only
41 took into account June through September inflow.

1 Appendix 2-D of the NMFS BO lists 72 different temperature target schedules for
 2 May through October. Each schedule changed the temperature target for one
 3 month only. It was deemed unnecessary to incorporate all 72 schedules due to the
 4 simplified forecasting approach described above that only focused on June to
 5 September inflow. This reduced the 72 schedules to schedules that focused
 6 primarily on temperature management during June through September.
 7 Ultimately the 72 schedules were reduced to 22 schedules as these schedules were
 8 deemed to adequately represent the variance in temperature targets during June
 9 through September.

10 Then, using an initial set of storage plus inflow tiers assigned to each temperature
 11 schedule number, the schedule number for each year of the CalSim II period of
 12 record was calculated. Then the average storage plus inflow for each tier was
 13 calculated. For example, there were 8 years over the simulation period that had a
 14 schedule number of 11 and the average storage plus inflow was 1,415 TAF. The
 15 average storage plus inflow calculated for each tier was plotted versus the
 16 schedule number, as shown in Figure 6B.C.57.

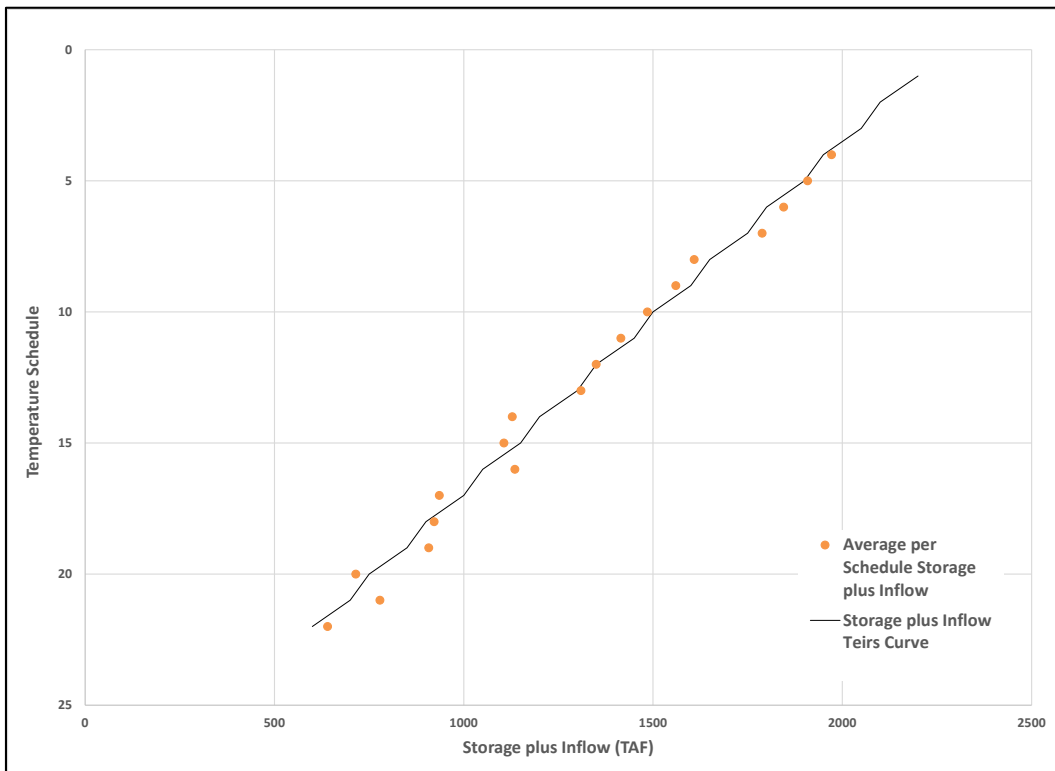

17
 18 **Figure 6B.C.57 Temperature Schedule Number and Average Folsom Lake Storage**
 19 **plus June-September Inflow for each Schedule Number**

20 The schedule shown in the plot was used to calculate the final storage plus inflow
 21 tiers used in the spreadsheet.

22 Using the regression equation shown in Figure 6B.C.57, the final storage plus
 23 inflow tiers to be used for the spreadsheet were calculated (see Table 6B.C.27).

1 **Table 6B.C.27 Final Watt Avenue Temperature Target Schedules (Yellow**
 2 **highlighted cells indicate a change from the previous schedule)**


Schedule	Storage plus June-Sept. Inflow	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
		56	56	56	63	61	61	62	62	61	57	56	56
1	0	56	56	56	63	61	61	62	62	61	57	56	56
2	600	56	56	56	63	62	62	62	62	62	58	56	56
3	700	56	56	56	63	62	62	63	63	62	59	57	56
4	750	56	56	56	63	63	63	63	63	63	60	57	56
5	850	56	56	56	63	63	63	64	64	63	60	58	56
6	900	56	56	56	63	64	64	64	64	64	60	58	56
7	1000	56	56	56	63	64	64	65	65	64	60	58	56
8	1050	56	56	56	63	65	65	65	65	65	60	58	56
9	1150	56	56	56	63	65	65	66	66	65	65	59	56
10	1200	56	56	56	63	66	66	66	66	66	65	59	56
11	1300	56	56	56	63	66	66	67	67	66	65	59	56
12	1350	56	56	56	63	67	67	67	67	67	65	59	56
13	1450	56	56	56	63	67	67	68	68	67	65	59	56
14	1500	56	56	56	63	68	68	68	68	68	65	59	56
15	1600	56	56	56	63	68	68	69	69	68	68	59	56
16	1650	56	56	56	63	69	69	69	69	69	68	59	56
17	1750	56	56	56	63	69	69	70	70	69	69	60	56
18	1800	56	56	56	63	70	70	70	70	70	69	60	56
19	1900	56	56	56	63	70	70	71	71	70	70	61	56
20	1950	56	56	56	63	71	71	71	71	71	70	61	56
21	2050	56	56	56	63	71	71	72	72	71	71	62	56
22	2100	56	56	56	63	72	72	72	72	72	71	62	56

3 January, February, March and December were given temperature targets of 56⁰F
 4 for all temperature schedules as a default. During these months, temperature
 5 management is generally not an issue. April was given a temperature target of
 6 63⁰F to conserve cold water in the reservoir pool at the start of the temperature
 7 management season.

8 Establishing the temperature target schedule sets the temperature targets at Watt
 9 Avenue. However, Folsom Dam can only actually operate to release
 10 temperatures, with the goal that those release temperatures will ultimately meet
 11 the Watt Avenue temperature target after ambient warming occurs. To calculate
 12 the Folsom release temperatures, the following logic was developed.

- 13 • **Step 1:** The American River HEC-5Q Model was run using the January 13,
 14 2015 version delivered to Reclamation, the CalSim II data described
 15 previously, and an initial Watt Avenue and Folsom Dam temperature target
 16 schedules. The temperature output from that HEC-5Q model run was loaded
 17 into the spreadsheet.

- 1 • **Step 2:** For each month individually, the difference (shift) between the
2 modeled temperature at Watt Avenue and the modeled temperature below
3 Folsom Dam was calculated for each year.
- 4 • **Step 3:** The annual shift calculated in Step 2 that represented a specified
5 exceedance for each month was then calculated. This helped characterize the
6 warming that occurred between Folsom release temperatures and Watt
7 Avenue. For example, September was given a 50 percent exceedance. This
8 exceedance says that 50 percent years had a September temperature shift
9 higher than this shift value (e.g., 0.6⁰F). Therefore, warming that occurred
10 between Folsom Dam and Watt Avenue in September for the previous model
11 run was 0.6⁰F or lower for 95 percent of years.
- 12 • **Step 4:** The exceedance shift value calculated in step iii was then divided by
13 the average annual June to September shift value. This calculated a shift
14 factor that was used in the final temperature shift calculations.
- 15 • **Step 5:** The average June to September shift value for each schedule number
16 was then calculated. For example, schedule number 11 was the schedule for
17 eight years over the simulation period and the average June to September shift
18 was 4.6⁰F.
- 19 • **Step 6:** The average June to September shift value calculated in Step v was
20 plotted versus its temperature schedule number, as shown in Figure 6B.C.58.
- 21 • **Step 7:** Average June to September shifts for each schedule number were then
22 calculated using the regression equation in Figure 6B.C.58.
- 23 • **Step 8:** The shift values calculated in step vii were then multiplied by the shift
24 factor calculated in step vii and was subtracted from the temperature target
25 value in Table 6B.C.27. This created the Folsom Dam release temperature
26 target schedules.
- 27 • **Step 9:** An iterative process where the Folsom Dam temperature target
28 schedules developed using the initial temperature target schedules described
29 in step 1 were then used in the next HEC5Q model run and then reloaded into
30 the spreadsheet. The process was repeated until the Folsom Dam release
31 temperature target schedules were deemed acceptable based on modeled
32 temperature results. The final Folsom Dam release temperature target
33 schedules are shown in Table 6B.C.28.

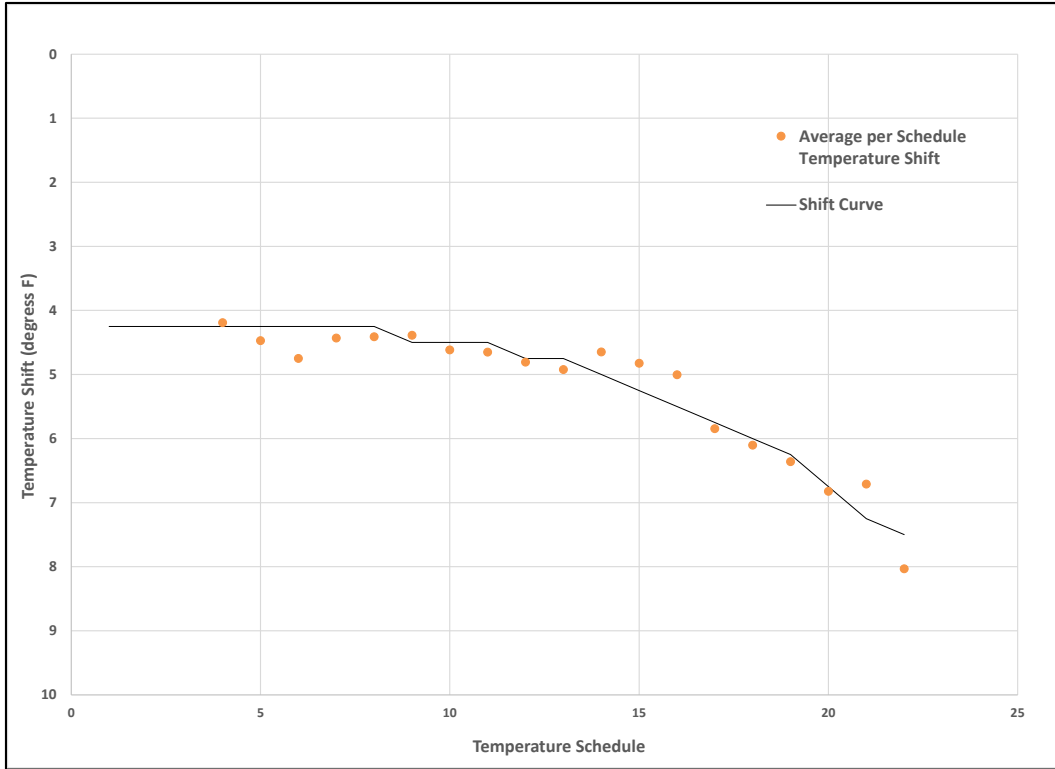

1
2
3
4
5
6
7
8
9

Figure 6B.C.58 Average Temperature Shift between Modeled Folsom Lake Release Temperatures and Watt Avenue Temperatures for each Schedule Number after Multiple Iterations

The shift curve shown in the plot was used to calculate the final temperature shifts used in the spreadsheet.

Table 6B.C.28 Final Folsom Dam Lake Release Temperature Targets in the Spreadsheet (Yellow highlighted cells indicate a change from the previous schedule)


Schedule	Storage plus Jun-Sep Inflow	Jan	Feb	Mar	Apr	Shift Factors							
						0.7	0.8	0.8	1.2	0.6	0.4	0.2	0
						May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
1	0	52	52	52	59	66.8	66.0	66.0	63.0	67.5	68.0	60.5	56
2	600	52	52	52	59	66.8	66.0	66.0	63.0	67.5	68.0	60.5	56
3	700	52	52	52	59	65.9	65.2	66.2	63.3	66.7	68.1	60.6	56
4	750	52	52	52	59	66.3	65.6	65.6	62.9	67.0	67.3	59.7	56
5	850	52	52	52	59	65.6	65.0	66.0	63.5	66.3	67.5	59.8	56
6	900	52	52	52	59	65.8	65.2	65.2	62.8	66.4	66.6	58.8	56
7	1000	52	52	52	59	65.0	64.4	65.4	63.1	65.6	66.7	58.9	56
8	1050	52	52	52	59	65.2	64.6	64.6	62.4	65.7	65.8	57.9	56
9	1150	52	52	52	59	64.3	63.8	64.8	62.7	64.9	65.9	58.0	56
10	1200	52	52	52	59	64.5	64.0	64.0	62.0	65.0	63.0	58.0	56
11	1300	52	52	52	59	63.7	63.2	64.2	62.3	64.2	63.1	58.1	56
12	1350	52	52	52	59	63.7	63.2	63.2	61.3	64.2	63.1	58.1	56

Schedule	Storage plus Jun-Sep Inflow	Jan	Feb	Mar	Apr	Shift Factors							
						0.7	0.8	0.8	1.2	0.6	0.4	0.2	0
						May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
13	1450	52	52	52	59	62.9	62.4	63.4	61.6	63.3	63.2	58.1	56
14	1500	52	52	52	59	62.9	62.4	62.4	60.6	63.3	63.2	58.1	56
15	1600	52	52	52	59	61.9	61.4	62.4	60.6	62.3	63.2	58.1	56
16	1650	52	52	52	59	62.0	61.6	61.6	59.9	62.5	58.3	57.2	56
17	1750	52	52	52	59	61.0	60.6	61.6	59.9	61.5	58.3	57.2	56
18	1800	52	52	52	59	61.0	60.6	60.6	58.9	61.5	58.3	57.2	56
19	1900	52	52	52	59	60.0	59.6	60.6	58.9	60.5	58.3	57.2	56
20	1950	52	52	52	59	60.0	59.6	59.6	57.9	60.5	58.3	56.2	56
21	2050	52	52	52	59	59.0	58.6	59.6	57.9	59.5	57.3	56.2	56
22	2100	52	52	52	59	59.0	58.6	58.6	56.9	59.5	56.3	55.2	56

1 January through April were not given shift factors and instead were given a
 2 constant 4⁰F shift as a default for the same reason described for those months for
 3 the Watt Avenue temperature target schedules.

4 **6B.C.12.3 Temperature Performance**

5 Figure 6B.C.59 shows box and whisker plots of modeled temperatures at Watt
 6 Avenue in the completed spreadsheet.

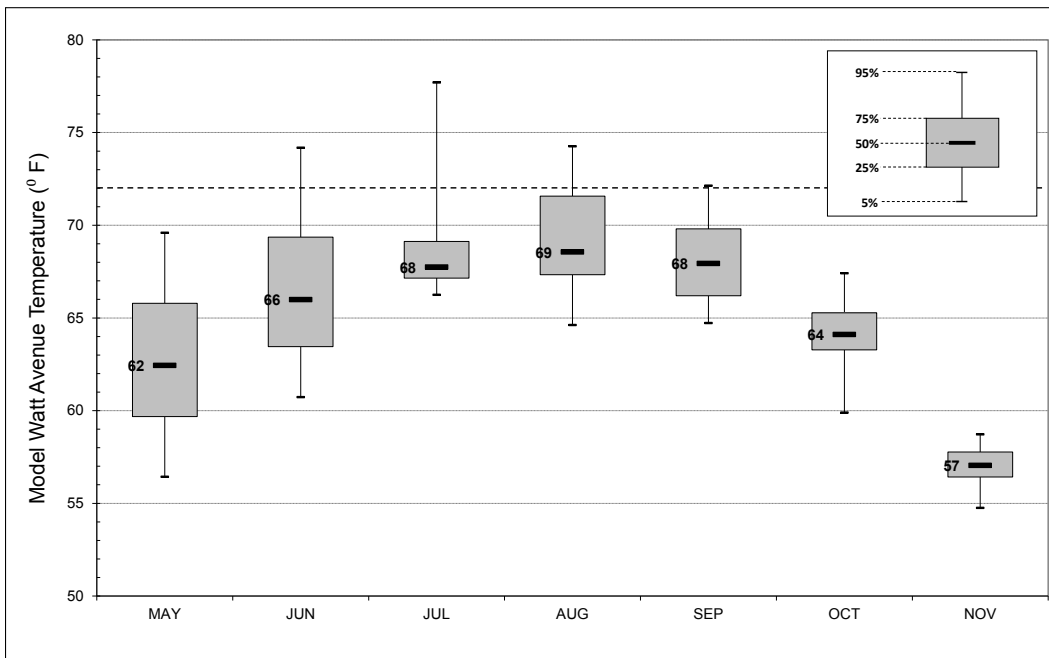

7
 8 **Figure 6B.C.59 Modeled Watt Avenue temperatures in Final Spreadsheet**

9 The figure shows the expected pattern where temperatures are higher in the
 10 summer but the Watt Avenue target temperature for each month were met in
 11 majority of the years. The maximum temperature target (72⁰F) was not exceeded

1 in approximately 75 percent of years for all months. The years where the
2 temperatures exceeded the maximum 72⁰F target were during dry periods, when
3 meeting the Watt Avenue temperature targets are not possible to meet due to low
4 storage in Folsom Lake.

5 **6B.C.13 References**

- 6 RMA (Resource Management Associates). 2003. *Upper Sacramento River*
7 *Water Quality Modeling with HEC-5Q: Model Calibration and*
8 *Validation.*
- 9 RMA (Resource Management Associates). 2013. *Development of the American*
10 *River HEC5Q Model.*
- 11 Reclamation (Bureau of Reclamation Central Valley Operations Office). 2015
12 *Sacramento River Temperature Report.* Site accessed February 13, 2015.
13 <http://www.usbr.gov/mp/cvo/vungvari/sactemprrpt.pdf>
- 14 Rettig, S. and G. Bortleson. 1983. *Limnological Study of Shasta Lake, Shasta*
15 *County, California, with Emphasis on the Effects of the 1977 Drought.*
16 U.S. Geological Survey.
- 17 Smith, D., M. Deas, and N. Jayasundara. 2013. *Extension of the Sacramento*
18 *River Water Quality Model (SRWQM) to Include American and Feather*
19 *River Representations.*
- 20 Wahl, T.L. and E.A. Cohen. 1999. *Determination of Controlled-Release*
21 *Capacity from Trinity Dam.* Proceedings from the 1999 International
22 Water Resources Engineering Conference, American Society of Civil
23 Engineers, August 8-11, 1999.

1 **Appendix 6C**

2 **Methylmercury Model Documentation**

3 This appendix provides information about the methods, modeling tools, and
 4 assumptions used for the Coordinated Long-term Operation of the Central Valley
 5 Project (CVP) and State Water Project (SWP) Environmental Impact Statement
 6 (EIS) analysis. It also provides information pertaining to the development of the
 7 analytical tools and the use of input data as well as model result processing and
 8 interpretation methods used for the impacts analysis and descriptions.

9 This appendix is organized into three main sections that are briefly described
 10 below:

- 11 • **Section 6C.1: Modeling Methodology.** The methylmercury impacts
 12 analysis used CalSim II, the Delta Simulation Model II (DSM2), and the
 13 Central Valley Regional Water Quality Control Board (Central Valley
 14 RWQCB) Total Maximum Daily Load (TMDL) model (RWQCB Model) to
 15 assess and quantify effects of the alternatives on the long-term operations of
 16 the CVP and SWP and on the environment. This section provides information
 17 about the overall analytical framework and how some of the model input
 18 information obtained from other models was processed through the use of
 19 analytical tools.
- 20 • **Section 6C.2: Modeling Simulations and Assumptions.** This section
 21 provides a brief description of the assumptions for the RWQCB Model
 22 simulations of the No Action Alternative, Second Basis of Comparison, and
 23 Alternatives 1 through 5.
- 24 • **Section 6C.3: Modeling Results.** This section provides a description of the
 25 model simulation output formats used in the analysis and interpretation of
 26 modeling results for the alternatives impacts assessment.

27 **6C.1 Modeling Methodology**

28 This section summarizes the methylmercury modeling methodology used for the
 29 No Action Alternative, Second Basis of Comparison, and Alternatives 1
 30 through 5. It describes the overall analytical framework and contains descriptions
 31 of the key analytical and numerical tools and approaches used in the quantitative
 32 evaluation of the alternatives. The alternatives include several major components
 33 that will have significant effects on SWP and CVP operations and minor effects
 34 on the water quality of the system.


35 **6C.1.1 Overview of the Modeling Approach and Objectives**

36 Modeling of physical and biological methylmercury processes in the Delta is
 37 necessary to evaluate changes related to the implementation of alternatives that
 38 could affect the health of humans and wildlife consuming fish in the Delta. It has
 39 been recognized that fish tissue concentrations are the best indicator of mercury

1 contamination in the Delta as described in the RWQCB Model (Central Valley
 2 RWQCB 2011). The RWQCB Model, an empirical tissue concentration model,
 3 was based on the concentration averages of fish mercury and water concentrations
 4 of methylmercury over broad areas of the Delta (Wood 2010). The RWQCB
 5 Model is used to estimate fish tissue mercury concentrations from concentrations
 6 of dissolved methylmercury in water.

7 CalSim II, DSM2 (water), and the RWQCB Model (fish tissue) were used in
 8 sequence to estimate the effects of CVP and SWP operations on water and fish
 9 tissue quality in the Delta. CalSim II simulates flow in the waterways, and DSM2
 10 simulates one-dimensional hydrodynamics in the Delta, as discussed in Chapter 5,
 11 Surface Water Resources and Water Supplies. One of the three DSM2 modules,
 12 QUAL, simulates one-dimensional source tracking in the Delta. Results from
 13 DSM2 proportioned by source area were multiplied by average source
 14 concentrations and added to determine annual average aqueous methylmercury
 15 concentrations in the Delta for all year types and dry years for specific model
 16 nodes. The RWQCB Model is based on a power curve that uses the DSM2 output
 17 to simulate aqueous methylmercury concentrations to estimate total mercury
 18 concentrations in the fish fillets of standard 350-mm-long Largemouth Bass.

19 Figure 6C.1 shows the modeling tools applied in the methylmercury impacts
 20 assessment and the relationship between these tools. Each model included in
 21 Figure 6C.1 provides information to the next “downstream” model in order to
 22 provide various results to support the impacts analysis.

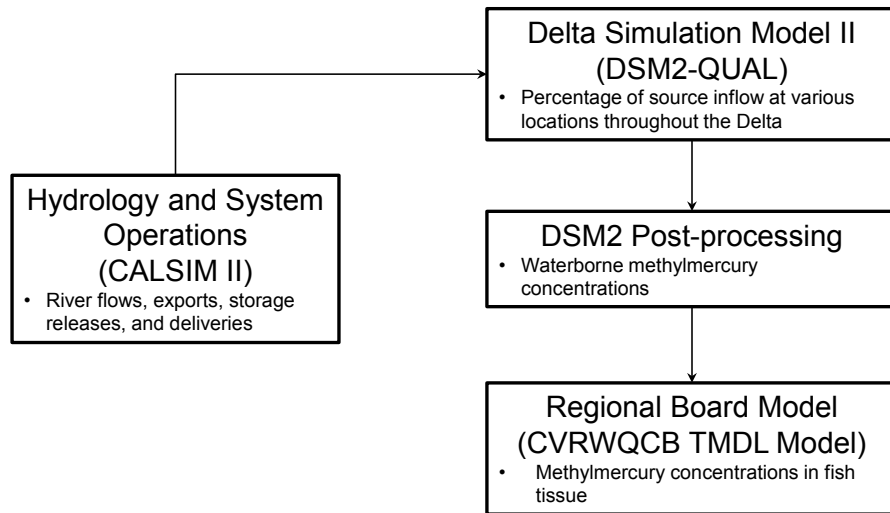

23

24 **Figure 6C.1. Relationships among the Different Predictive Modeling Tools**

25 **6C.1.1.1 Modeling Objectives**

26 Impacts on methylmercury resources in the Delta SWP and CVP Service Areas
 27 were evaluated for each alternative as part of the EIS development. Modeling
 28 objectives included the evaluation of the following:

- 29
- Percent changes in fish tissue mercury concentrations
 - Exceedances of human and fish and wildlife thresholds
- 30

1 **6C.1.2 Key Components of the Methylmercury Modeling**

2 A calibrated regional flow model was used to provide a regional framework to be
 3 used for modeling of waterborne methylmercury concentrations. An additional
 4 model was used to translate waterborne methylmercury concentrations to total
 5 mercury concentrations in fish tissue.

6 **6C.1.2.1 DSM2 Postprocessing**

7 Dissolved methylmercury data were available for six inflow locations to the Delta
 8 (Table 6C.1):

- 9 • Sacramento River at Freeport (mainstem flow to Delta)
- 10 • San Joaquin River at Vernalis (mainstem flow to Delta)
- 11 • Mokelumne and Calaveras rivers (for Eastside tributaries)
- 12 • Various Delta locations (for Delta agriculture)
- 13 • Suisun Bay (for San Francisco Bay)

14 **Table 6C.1. Modeled Methylmercury Concentrations in Water**

Location	Period*	Period Average Concentration (ng/L)			
		No Action Alternative	Alternative 1	Alternative 3	Alternative 5
Delta Interior					
San Joaquin River at Stockton	All	0.16	0.16	0.16	0.16
	Drought	0.16	0.16	0.17	0.16
Turner Cut	All	0.15	0.15	0.15	0.15
	Drought	0.14	0.14	0.14	0.14
San Joaquin River at San Andreas Landing	All	0.12	0.11	0.11	0.12
	Drought	0.11	0.11	0.11	0.11
San Joaquin River at Jersey Point	All	0.11	0.11	0.11	0.11
	Drought	0.11	0.10	0.10	0.11
Victoria Canal	All	0.14	0.14	0.14	0.14
	Drought	0.14	0.13	0.14	0.14
Western Delta					
Sacramento River at Emmaton	All	0.10	0.10	0.10	0.10
	Drought	0.10	0.10	0.10	0.10
San Joaquin River at Antioch	All	0.10	0.10	0.10	0.10
	Drought	0.09	0.09	0.09	0.10

Location	Period*	Period Average Concentration (ng/L)			
		No Action Alternative	Alternative 1	Alternative 3	Alternative 5
Montezuma Slough at Hunter Cut/ Beldon's Landing	All	0.08	0.08	0.08	0.08
	Drought	0.07	0.07	0.07	0.07
Major Diversions (Pumping Stations)					
North Bay Aqueduct at Barker Slough Pumping Plant	All	0.11	0.11	0.11	0.11
	Drought	0.11	0.11	0.11	0.11
Contra Costa Pumping Plant #1	All	0.13	0.13	0.13	0.13
	Drought	0.12	0.12	0.12	0.13
Banks Pumping Plant	All	0.14	0.13	0.13	0.14
	Drought	0.13	0.13	0.13	0.13
Jones Pumping Plant	All	0.14	0.14	0.14	0.14
	Drought	0.14	0.13	0.14	0.14

- 1 Notes:
- 2 ng/L = nanogram per liter
- 3 * "All" water years 1922-2003 represent the 82-year period modeled using DSM2;
- 4 "drought" represents a 5-consecutive-year (water years 1987-1991) drought period
- 5 consisting of dry and critical water year types (as defined by the Sacramento Valley
- 6 40-30-30 water year hydrologic classification index).
- 7 Model results for Alternatives 1, 4, and Second Basis of Comparison are the same,
- 8 therefore model results for Second Basis of Comparison and Alternative 4 are not
- 9 presented separately.
- 10 Model results for Alternative 2 and No Action Alternative are the same, therefore model
- 11 results for Alternative 2 are not presented separately.

- 12 For DSM2 output locations, the geometric mean methylmercury concentrations
- 13 from the inflow locations were combined with the modeled daily average percent
- 14 inflow for each DSM2 output location to estimate waterborne methylmercury
- 15 concentrations at those locations. The annual average mix of water from the
- 16 six inflow sources (Table 6C.1) was calculated from daily percent inflows
- 17 provided by the DSM2-QUAL model output. The daily waterborne
- 18 methylmercury concentrations at DSM2 locations were calculated using the
- 19 following equation:
- 20 $C_{water\ quarterly} = [(I_1 * C_1) + (I_2 * C_2) + (I_3 * C_3) + (I_4 * C_4) + (I_5 * C_5) + (I_6 * C_6)] / 100$

1 Where:

- 2 • $C_{water\ daily}$ = daily average methylmercury concentration in water
3 (micrograms/liter [$\mu\text{g/L}$]) at a DSM2 output location
- 4 • I_{1-6} = modeled daily inflow from each of the six sources of water to the Delta
5 for each DSM2 output location (percentage)
- 6 • C_{1-6} = methylmercury concentration in water ($\mu\text{g/L}$) from each of the six
7 inflow sources to the Delta (1-6)

8 The annual average waterborne methylmercury concentrations for the DSM2
9 output locations are shown in Table 6C.1.

10 **6C.1.2.2 Regional Board Fish Tissue Model**

11 The RWQCB Model predicts methylmercury concentration in 350-millimeter
12 normalized Largemouth Bass fillet tissue from methylmercury in water. The
13 Central Valley RWQCB developed an empirical power curve model based on
14 measured Largemouth Bass fillet concentrations as averaged over large areas of
15 the Delta compared to average methylmercury concentrations in water for those
16 same areas and time periods (Central Valley RWQCB 2011):

17 *Fish mercury (milligrams/kilogram, wet weight) = 20.365 × (methylmercury in*
18 *water, ng/L)^{1.6374}*
19 *(with $r^2=0.910$, and P less than 0.05)*

20 The goal of the RWQCB Model was to establish the linkage between the
21 0.24 milligram per kilogram (mg/kg) tissue mercury TMDL target to a waterborne
22 goal of 0.066 ng methylmercury/L. The RWQCB Model results are presented
23 with the recognition of the imprecision of predicting fish tissue concentrations
24 from estimates of methylmercury concentrations for specific Delta locations, but
25 with the knowledge that Largemouth Bass are probably the best indicator of fish
26 tissue contamination (see Section 6C.1.2.3). Results provide an estimated mean
27 tissue concentration as would be expected by location and alternative. The model
28 provides a Delta-specific, empirical estimate of the relationship between
29 waterborne methylmercury and bioaccumulated fish tissue mercury.

30 The overall construction and calibration of the RWQCB Model were unchanged
31 for this EIS analysis.

32 **6C.1.2.3 Model Development**

33 The RWQCB Model is based on unfiltered aqueous methylmercury data from
34 March to October 2000 and Largemouth Bass fillet concentration data from
35 September/October 2000. Largemouth Bass samples were chosen close in time
36 and space to water collections. The paired samples, averaged over broad Delta
37 areas, provided the framework for the nonlinear empirical model. Data were
38 grouped by subareas of the Delta such as Sacramento River, Mokelumne River,
39 Central Delta, San Joaquin River, and West Delta.

1 Largemouth Bass are excellent indicators of mercury contamination because they
2 have a relatively high level of mercury compared to other species, are piscivorous,
3 are abundantly distributed throughout the Delta, are popular gamefish, and have
4 high site fidelity. Largemouth Bass are therefore representative of spatial patterns
5 of tissue mercury concentrations throughout the aquatic food web, including
6 exposure to humans.

7 The RWQCB Model was used to convert DSM2 estimated waterborne
8 methylmercury concentrations to fish tissue mercury concentrations. The toxicity
9 benchmark used to assess impacts of alternatives was the Central Valley RWQCB
10 TMDL tissue concentration goal of 0.24 mg/kg wet weight (ww) of mercury for
11 normalized 350-mm total length Largemouth Bass tissue (Central Valley
12 RWQCB 2011).

13 **6C.2 Modeling Simulations and Assumptions**

14 This section describes the assumptions for the RWQCB Model simulations of the
15 No Action Alternative, Second Basis of Comparison, and Alternatives 1
16 through 5. Model results for Alternatives 1, 4, and Second Basis of Comparison
17 are the same, therefore model results for Second Basis of Comparison and 4 are
18 not presented separately. Model results for Alternative 2 and No Action
19 Alternative are the same, therefore model results for Alternative 2 are not
20 presented separately. A description of DSM2 model assumptions is presented in
21 Appendix 5A.

22 **6C.2.1 Location Assumptions**

23 The Central Valley RWQCB developed a nonlinear model based on Largemouth
24 Bass as grouped in large regions of the Delta (rather than specific locations)
25 compared to average methylmercury concentrations in water for those same,
26 general regions (Central Valley RWQCB 2011). As such, the model provides a
27 Delta-specific, general, long-term average relationship between co-located
28 waterborne methylmercury concentrations and total mercury concentrations in
29 Largemouth Bass fillets.

30 **6C.2.2 Normalization and Tissue Type Assumptions**

31 As discussed above, Largemouth Bass are excellent indicators of long-term
32 average mercury exposure, risk, and the spatial pattern for both ecological and
33 human health effects. A fish tissue mercury dataset was available for Largemouth
34 Bass from locations across the Delta. However, the Largemouth Bass tissue
35 mercury concentrations were presented as edible fillet concentrations for fish
36 normalized to 350 mm in total length (SFEI 2010). It is important to standardize
37 concentrations to the same length fish for establishment of the model and for
38 model predictions because of the well-established positive relationship between
39 fish length and age and tissue mercury concentrations (e.g., Alpers et al. 2008).
40 This same normalization technique was used by the Regional Board for their
41 model (Central Valley RWQCB 2011). The 350-mm size fish is an appropriate

1 size representative of human health consumption and risk. The standardized size
2 allows the best comparison among locations and alternatives. The fillet
3 concentrations predicted by the model are expected to be slightly different from
4 whole-body fish concentrations as consumed by wildlife, but comparisons among
5 locations and alternatives and to the Regional Board benchmark will allow an
6 evaluation of relative impacts to fish and wildlife as well as most accurately
7 estimating impacts to human consumers.

8 **6C.2.3 Model Application Methodology**

9 To evaluate differences between the No Action Alternative, Second Basis of
10 Comparison, and other alternatives for impact assessment, modeled
11 methylmercury concentrations were compared directly (for percent change) and to
12 the 0.24-mg/kg wet weight tissue threshold benchmark.

13 Results of comparisons to these benchmarks are expressed as exceedance
14 quotients (EQs) in some of the tables and figures. Annual average methylmercury
15 concentrations in water did not exceed the unfiltered aqueous methylmercury goal
16 (0.06 µg/L) or the California Toxic Rule criterion for the consumption of water at
17 the organism (0.050 µg/L) and of the organism only (0.051 µg/L), so no EQs
18 were calculated for waterborne concentrations.

19 **6C.2.3.1 No Action Alternative and Second Basis of Comparison** 20 **Model Runs**

21 The overall purpose of the models is to provide a set of conditions for the No
22 Action Alternative and the Second Basis of Comparison to be used for
23 comparison with the forecasts of the alternatives to determine whether the
24 implementation of the alternatives is likely to result in substantial impacts to
25 methylmercury, thereby affecting biological resources. Modeling for the No
26 Action Alternative and the Second Basis of Comparison was completed for five
27 Delta interior locations, three western Delta locations, and four locations near
28 major water diversions. DSM2 postprocessing output provided estimates of the
29 waterborne methylmercury concentration at each of those 12 locations
30 (Table 6C.1). The RWQCB Model was then used to estimate methylmercury
31 tissue concentrations in 350-mm Largemouth Bass. The modeled tissue
32 methylmercury concentrations and the EQs (based on comparisons to
33 thresholds) both served as a basis for comparison of other alternatives to
34 identify potential impacts.

35 **6C.2.3.2 Alternatives 1 through 5 Model Runs**

36 For model simulations of Alternatives 1 through 5, the same procedure as
37 described for the No Action Alternative and the Second Basis of Comparison was
38 used with similar assumptions.

39 **6C.3 Modeling Results**

40 The postprocessing tool that presents the results from the RWQCB Model is an
41 Excel-based spreadsheet tool. The general preprocessing and input files

1 development are described in the modeling data assumptions sections above.
2 This section focuses on data analysis and results interpretation for the impacts
3 descriptions.

4 **6C.3.1 Postprocessing and Results Analysis: Delta-wide Model**

5 Output data resulting from the RWQCB Model simulations for each alternative
6 were processed to provide a tabular depiction of potential impacts to
7 methylmercury resources (Tables 6C.2 – 6C.4). As discussed previously, outputs
8 from the RWQCB Model used in this analysis are annual average fish tissue
9 mercury concentrations for all year types and separately presented for the subset
10 of dry years.

11 All annual average concentrations exceed the TMDL target goal of 0.24 mg/kg
12 tissue mercury at all locations modeled in the Delta for all years both as measured
13 and modeled. Results are shown in Tables 6C.2 – 6C.4 and Figures 6C.2
14 and 6C.3. Table 6C.1 presents the period-average waterborne methylmercury
15 concentrations by location and water year type as used to model fish tissue
16 concentrations (Tables 6C.2 – 6C.4).

17 The differences in fish tissue mercury concentrations over long-term average
18 conditions were reduced or similar (5 percent or less) under Alternatives 1
19 through 5 as compared to the No Action Alternative, and under the No Action
20 Alternative and Alternatives 1 through 4 as compared to the Second Basis of
21 Comparison, as shown in Tables 6C.2 – 6C.4. Fish tissue mercury
22 concentrations over long-term average conditions are greater than 5 percent under
23 Alternative 5 as compared to the Second Basis of Comparison in the Suisun
24 Marsh (Montezuma Slough at Hunter Cut/Beldon's Landing), and near Delta
25 water intakes (San Joaquin River at Antioch, Contra Costa Pumping Plant
26 Number 1, Banks Pumping Plant, and Jones Pumping Plant).

27 Model results for Alternatives 1, 4, and Second Basis of Comparison are the
28 same, therefore model results for Alternative 4 are not presented separately.
29 Model results for Alternative 2 and No Action Alternative are the same, therefore
30 model results for Alternative 2 are not presented separately.

31 **6C.3.2 Model Limitations and Applicability**

32 Although it is impossible to predict future hydrology, land use, and water use with
33 certainty, the RWQCB Model and DSM2 were used to forecast impacts on fish
34 that could result from implementation of the alternatives. Mathematical models
35 like DSM2 can only approximate processes of physical systems. Models are
36 inherently inexact because the mathematical description of the physical system is
37 imperfect and the understanding of interrelated physical processes is incomplete.
38 However, the RWQCB Model is a powerful tool that, when used carefully, can
39 provide useful insight into processes of the physical system. Methylmercury
40 concentrations for inflow sources to the Delta (e.g., agriculture in the Delta, Yolo
41 Bypass, Eastside Tributaries) also caused uncertainty in the modeling because of
42 limited data. For the Sacramento River and the San Joaquin River, about 90 data
43 points (Chapter 6, Table 6.58; Table 6D.1) were used to estimate the mean

1 methylmercury concentrations for these inflow sources, whereas the mean
2 methylmercury concentrations for other inflow sources to the Delta had many
3 fewer data points, ranging from 14 to no data points (concentrations for the
4 Eastside Tributaries were assumed).

5 **6C.4 References**

- 6 Alpers, C. N., C. Eagles-Smith, C. Foe, S. Klasing, M. C. Marvin-DiPasquale,
7 D. G. Slotton, and L. Windham-Meyers. 2008. *Sacramento–San Joaquin*
8 *Delta Regional Ecosystem Restoration Implementation Plan, Ecosystem*
9 *Conceptual Model*. *Mercury*. January 24.
- 10 Central Valley RWQCB (Central Valley Regional Water Quality Control Board).
11 2011. *Sacramento–San Joaquin Delta Estuary TMDL for Methylmercury*.
12 *Final EPA Approval of Basin Plan Amendment*. Oct. 20.
- 13 SFEI (San Francisco Estuary Institute). 2010. Regional Data Center. Site accessed
14 April 13,2010. <http://www.sfei.org/data>
- 15 Wood, M., C. Foe, J. Cooke, and L. Stephen. 2010. *Sacramento–San Joaquin*
16 *Delta Estuary TMDL for Methylmercury, Final Staff Report*. April.
17 Prepared for California Regional Water Quality Control Board: Central
18 Valley Region, Rancho Cordova, CA.

1 **Table 6C.2. Summary Table for Methylmercury Concentrations in 350-mm Largemouth Bass Fillets for No Action**
 2 **Alternative, Second Basis of Comparison, and Alternative 1**

Location	Period ^a	Estimated Concentrations of Methylmercury (mg/kg ww) No Action Alternative	Estimated Concentrations of Methylmercury (mg/kg ww) Second Basis of Comparison and Alternative 1	% Change In Methylmercury Concentrations ^b Alternative 1 compared to No Action Alternative	% Change In Methylmercury Concentrations ^b No Action Alternative compared to Second Basis of Comparison	Exceedance Quotients ^c No Action Alternative	Exceedance Quotients ^c Second Basis of Comparison and Alternative 1
Delta Interior							
San Joaquin River at Stockton	All	1.00	0.99	0	0	4.2	4.1
	Drought	1.06	1.06	0	0	4.4	4.4
Turner Cut	All	0.89	0.87	-3	3	3.7	3.6
	Drought	0.84	0.81	-4	4	3.5	3.4
San Joaquin River at San Andreas Landing	All	0.59	0.58	-3	3	2.5	2.4
	Drought	0.54	0.53	-3	3	2.3	2.2
San Joaquin River at Jersey Point	All	0.57	0.54	-4	5	2.4	2.3
	Drought	0.52	0.50	-4	4	2.2	2.1
Victoria Canal	All	0.85	0.82	-4	4	3.6	3.4
	Drought	0.82	0.76	-6	7	3.4	3.2
Western Delta							
Sacramento River at Emmaton	All	0.50	0.49	-2	2	2.1	2.0
	Drought	0.48	0.47	-2	2	2.0	2.0
San Joaquin River at Antioch	All	0.50	0.47	-6	7	2.1	2.0
	Drought	0.43	0.41	-5	5	1.8	1.7

Location	Period ^a	Estimated Concentrations of Methylmercury (mg/kg ww) No Action Alternative	Estimated Concentrations of Methylmercury (mg/kg ww) Second Basis of Comparison and Alternative 1	% Change In Methylmercury Concentrations ^b Alternative 1 compared to No Action Alternative	% Change In Methylmercury Concentrations ^b No Action Alternative compared to Second Basis of Comparison	Exceedance Quotients ^c No Action Alternative	Exceedance Quotients ^c Second Basis of Comparison and Alternative 1
Montezuma Slough at Hunter Cut/Beldon's Landing	All	0.35	0.32	-6	7	1.4	1.4
	Drought	0.28	0.26	-5	5	1.1	1.1
Major Diversions (Pumping Stations)							
North Bay Aqueduct at Barker Slough Pumping Plant	All	0.56	0.56	-1	1	2.4	2.3
	Drought	0.59	0.57	-2	2	2.4	2.4
Contra Costa Pumping Plant #1	All	0.73	0.68	-6	6	3.0	2.8
	Drought	0.67	0.62	-7	8	2.8	2.6
Banks Pumping Plant	All	0.79	0.75	-5	5	3.3	3.1
	Drought	0.75	0.69	-7	8	3.1	2.9
Jones Pumping Plant	All	0.83	0.79	-4	4	3.5	3.3
	Drought	0.82	0.77	-6	7	3.4	3.2

- 1 Notes:
- 2 mg/kg = milligram per kilogram
- 3 ww = wet weight
- 4 a. "All": water years (1922-2003) represent the 82-year period modeled using DSM2. "Drought" Represents a 5-consecutive-year (water years 1987-1991) drought
- 5 period consisting of dry and critical water year types (as defined by the Sacramento Valley 40-30-30 water year hydrologic classification index).
- 6 b. % change indicates a negative change (increased concentrations) relative to No Action Alternative or Second Basis of Comparison when values are positive
- 7 and a positive change (lowered concentrations) relative to No Action Alternative or Second Basis of Comparison when values are negative.
- 8 c. Concentrations greater than 0.24 mg/kg ww mercury exceed the TMDL guidance concentration.

1 **Table 6C.3 Summary Table for Methylmercury Concentrations in 350-mm Largemouth Bass Fillets for Alternative 3**

Location	Period ^a	Estimated Concentrations of Methylmercury (mg/kg, ww) Alternative 3	% Change In Methylmercury Concentrations ^b No Action Alternative	% Change In Methylmercury Concentrations ^b Second Basis of Comparison	Exceedance Quotients ^c Alternative 3
Delta Interior					
San Joaquin River at Stockton	All	1.00	1	1	4.2
	Drought	1.07	1	1	4.5
Turner Cut	All	0.88	-2	1	3.7
	Drought	0.82	-3	1	3.4
San Joaquin River at San Andreas Landing	All	0.58	-3	0	2.4
	Drought	0.53	-2	1	2.2
San Joaquin River at Jersey Point	All	0.55	-4	1	2.3
	Drought	0.51	-2	2	2.1
Victoria Canal	All	0.83	-2	2	3.5
	Drought	0.79	-3	3	3.3
Western Delta					
Sacramento River at Emmaton	All	0.49	-2	0	2.0
	Drought	0.47	-1	0	2.0
San Joaquin River at Antioch	All	0.48	-6	1	2.0
	Drought	0.42	-3	2	1.7
Montezuma Slough at Hunter Cut/Beldon's Landing	All	0.33	-6	1	1.4
	Drought	0.27	-3	2	1.1

Location	Period ^a	Estimated Concentrations of Methylmercury (mg/kg, ww) Alternative 3	% Change In Methylmercury Concentrations ^b No Action Alternative	% Change In Methylmercury Concentrations ^b Second Basis of Comparison	Exceedance Quotients ^c Alternative 3
Major Diversions (Pumping Stations)					
North Bay Aqueduct at Barker Slough Pumping Plant	All	0.56	-1	0	2.3
	Drought	0.58	-1	2	2.4
Contra Costa Pumping Plant #1	All	0.69	-5	1	2.9
	Drought	0.64	-4	4	2.7
Banks Pumping Plant	All	0.77	-3	2	3.2
	Drought	0.72	-4	4	3.0
Jones Pumping Plant	All	0.81	-3	2	3.4
	Drought	0.80	-3	4	3.3

Notes:

mg/kg = milligram per kilogram

ww = wet weight

a. "All": water years (1922-2003) represent the 82-year period modeled using DSM2. "Drought" Represents a 5-consecutive-year (water years 1987-1991) drought period consisting of dry and critical water year types (as defined by the Sacramento Valley 40-30-30 water year hydrologic classification index).

b. % change indicates a negative change (increased concentrations) relative to No Action Alternative or Second Basis of Comparison when values are positive and a positive change (lowered concentrations) relative to No Action Alternative or Second Basis of Comparison when values are negative.

c. Concentrations greater than 0.24 mg/kg ww mercury exceed the TMDL guidance concentration.


1 **Table 6C.4. Summary Table for Methylmercury Concentrations in 350-mm Largemouth Bass Fillets for No Action**
 2 **Alternative, Second Basis of Comparison, and Alternative 5**

Location	Period ^a	Estimated Concentrations of Methylmercury (mg/kg, ww) Alternative 5	% Change In Methylmercury Concentrations ^b No Action Alternative	% Change In Methylmercury Concentrations ^b Second Basis of Comparison	Exceedance Quotients ^c Alternative 5
Delta Interior					
San Joaquin River at Stockton	All	1.00	0	0	4.1
	Drought	1.05	0	0	4.4
Turner Cut	All	0.89	0	3	3.7
	Drought	0.85	1	4	3.5
San Joaquin River at San Andreas Landing	All	0.60	1	4	2.5
	Drought	0.55	2	4	2.3
San Joaquin River at Jersey Point	All	0.57	1	5	2.4
	Drought	0.53	2	5	2.2
Victoria Canal	All	0.85	0	4	3.6
	Drought	0.82	0	7	3.4
Western Delta					
Sacramento River at Emmaton	All	0.50	0	3	2.1
	Drought	0.49	1	3	2.0
San Joaquin River at Antioch	All	0.51	1	7	2.1
	Drought	0.44	2	7	1.8
Montezuma Slough at Hunter Cut/Beldon's Landing	All	0.35	1	7	1.5
	Drought	0.28	1	7	1.2

Location	Period ^a	Estimated Concentrations of Methylmercury (mg/kg, ww) Alternative 5	% Change In Methylmercury Concentrations ^b No Action Alternative	% Change In Methylmercury Concentrations ^b Second Basis of Comparison	Exceedance Quotients ^c Alternative 5
Major Diversions (Pumping Stations)					
North Bay Aqueduct at Barker Slough Pumping Plant	All	0.56	0	1	2.4
	Drought	0.58	0	2	2.4
Contra Costa Pumping Plant #1	All	0.74	2	8	3.1
	Drought	0.70	5	13	2.9
Banks Pumping Plant	All	0.79	0	5	3.3
	Drought	0.74	-1	7	3.1
Jones Pumping Plant	All	0.83	0	5	3.5


- 1 Notes:
- 2 mg/kg = milligram per kilogram
- 3 ww = wet weight
- 4 a. "All": water years (1922-2003) represent the 82-year period modeled using DSM2. "Drought" Represents a 5-consecutive-year (water years
- 5 1987-1991) drought period consisting of dry and critical water year types (as defined by the Sacramento Valley 40-30-30 water year hydrologic
- 6 classification index).
- 7 b. % change indicates a negative change (increased concentrations) relative to No Action Alternative or Second Basis of Comparison when
- 8 values are positive and a positive change (lowered concentrations) relative to No Action Alternative or Second Basis of Comparison when values
- 9 are negative. Changes of 10% or more are shaded.
- 10 c. Concentrations greater than 0.24 mg/kg ww mercury exceed the TMDL guidance concentration.

This page left blank intentionally.

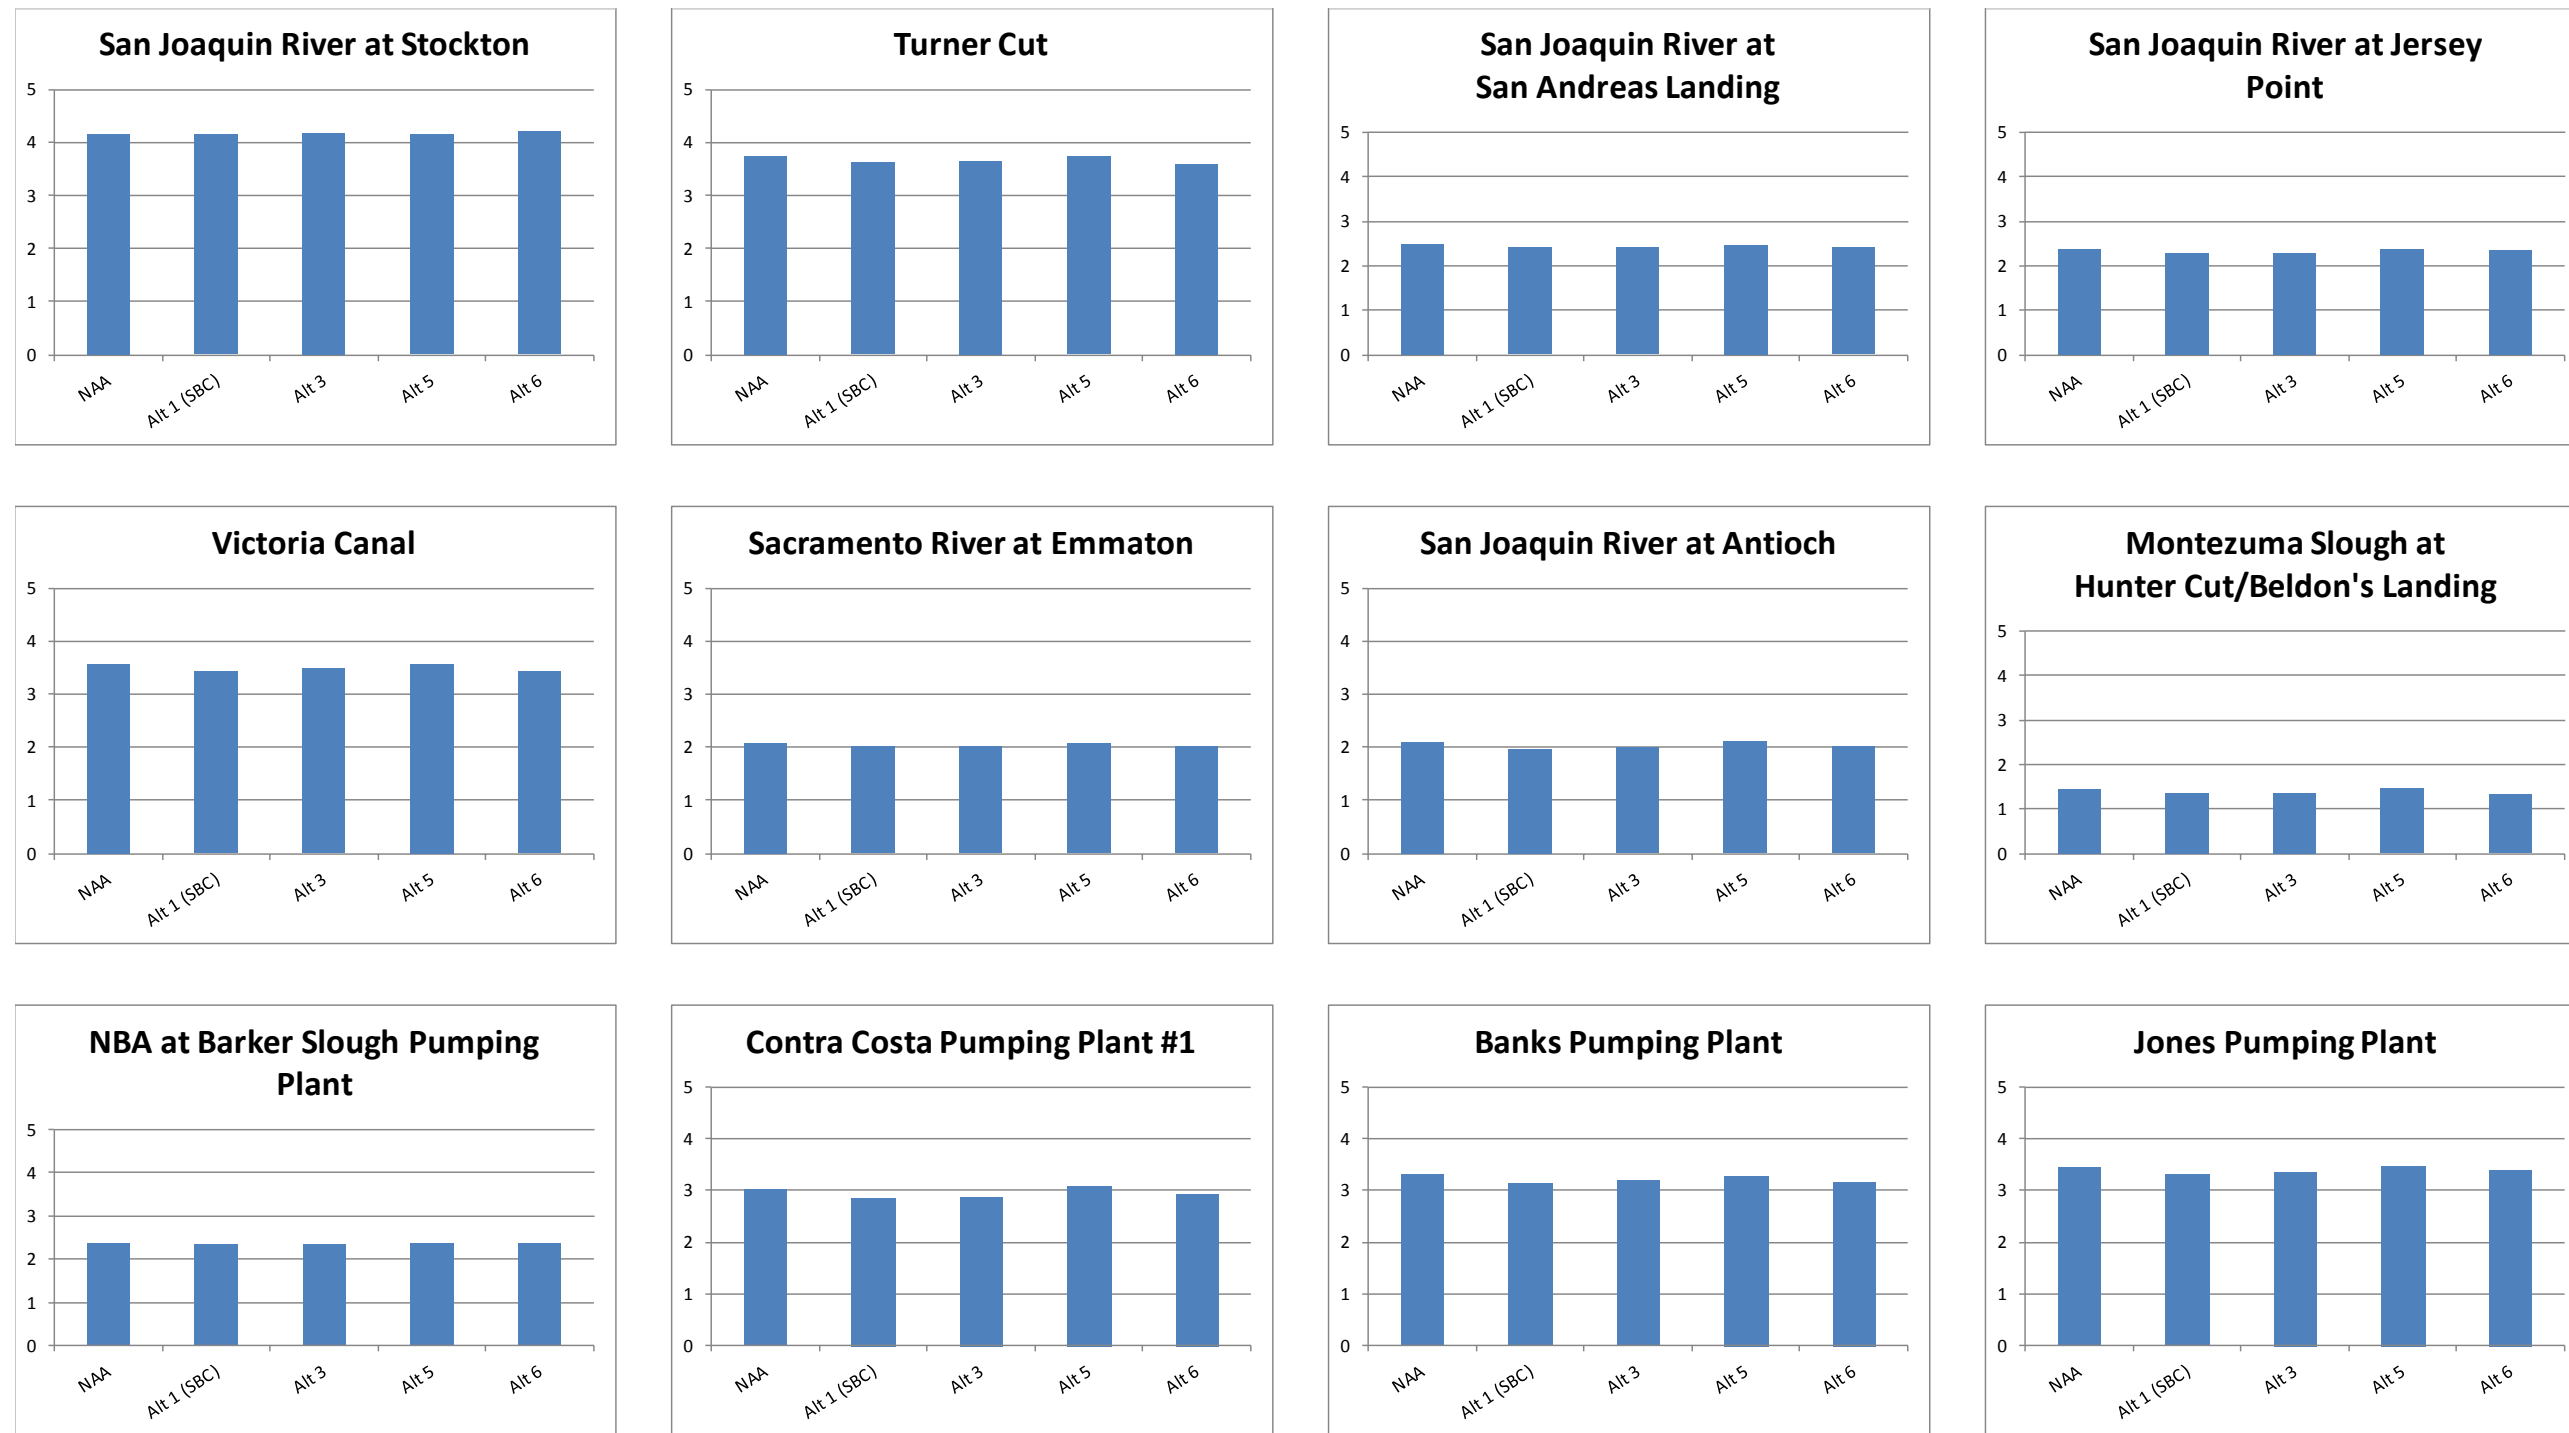

1

2 Figure 6C.2 Level of Concern Exceedance Quotients for Mercury Concentrations in 350-mm Largemouth Bass Fillets for All Years

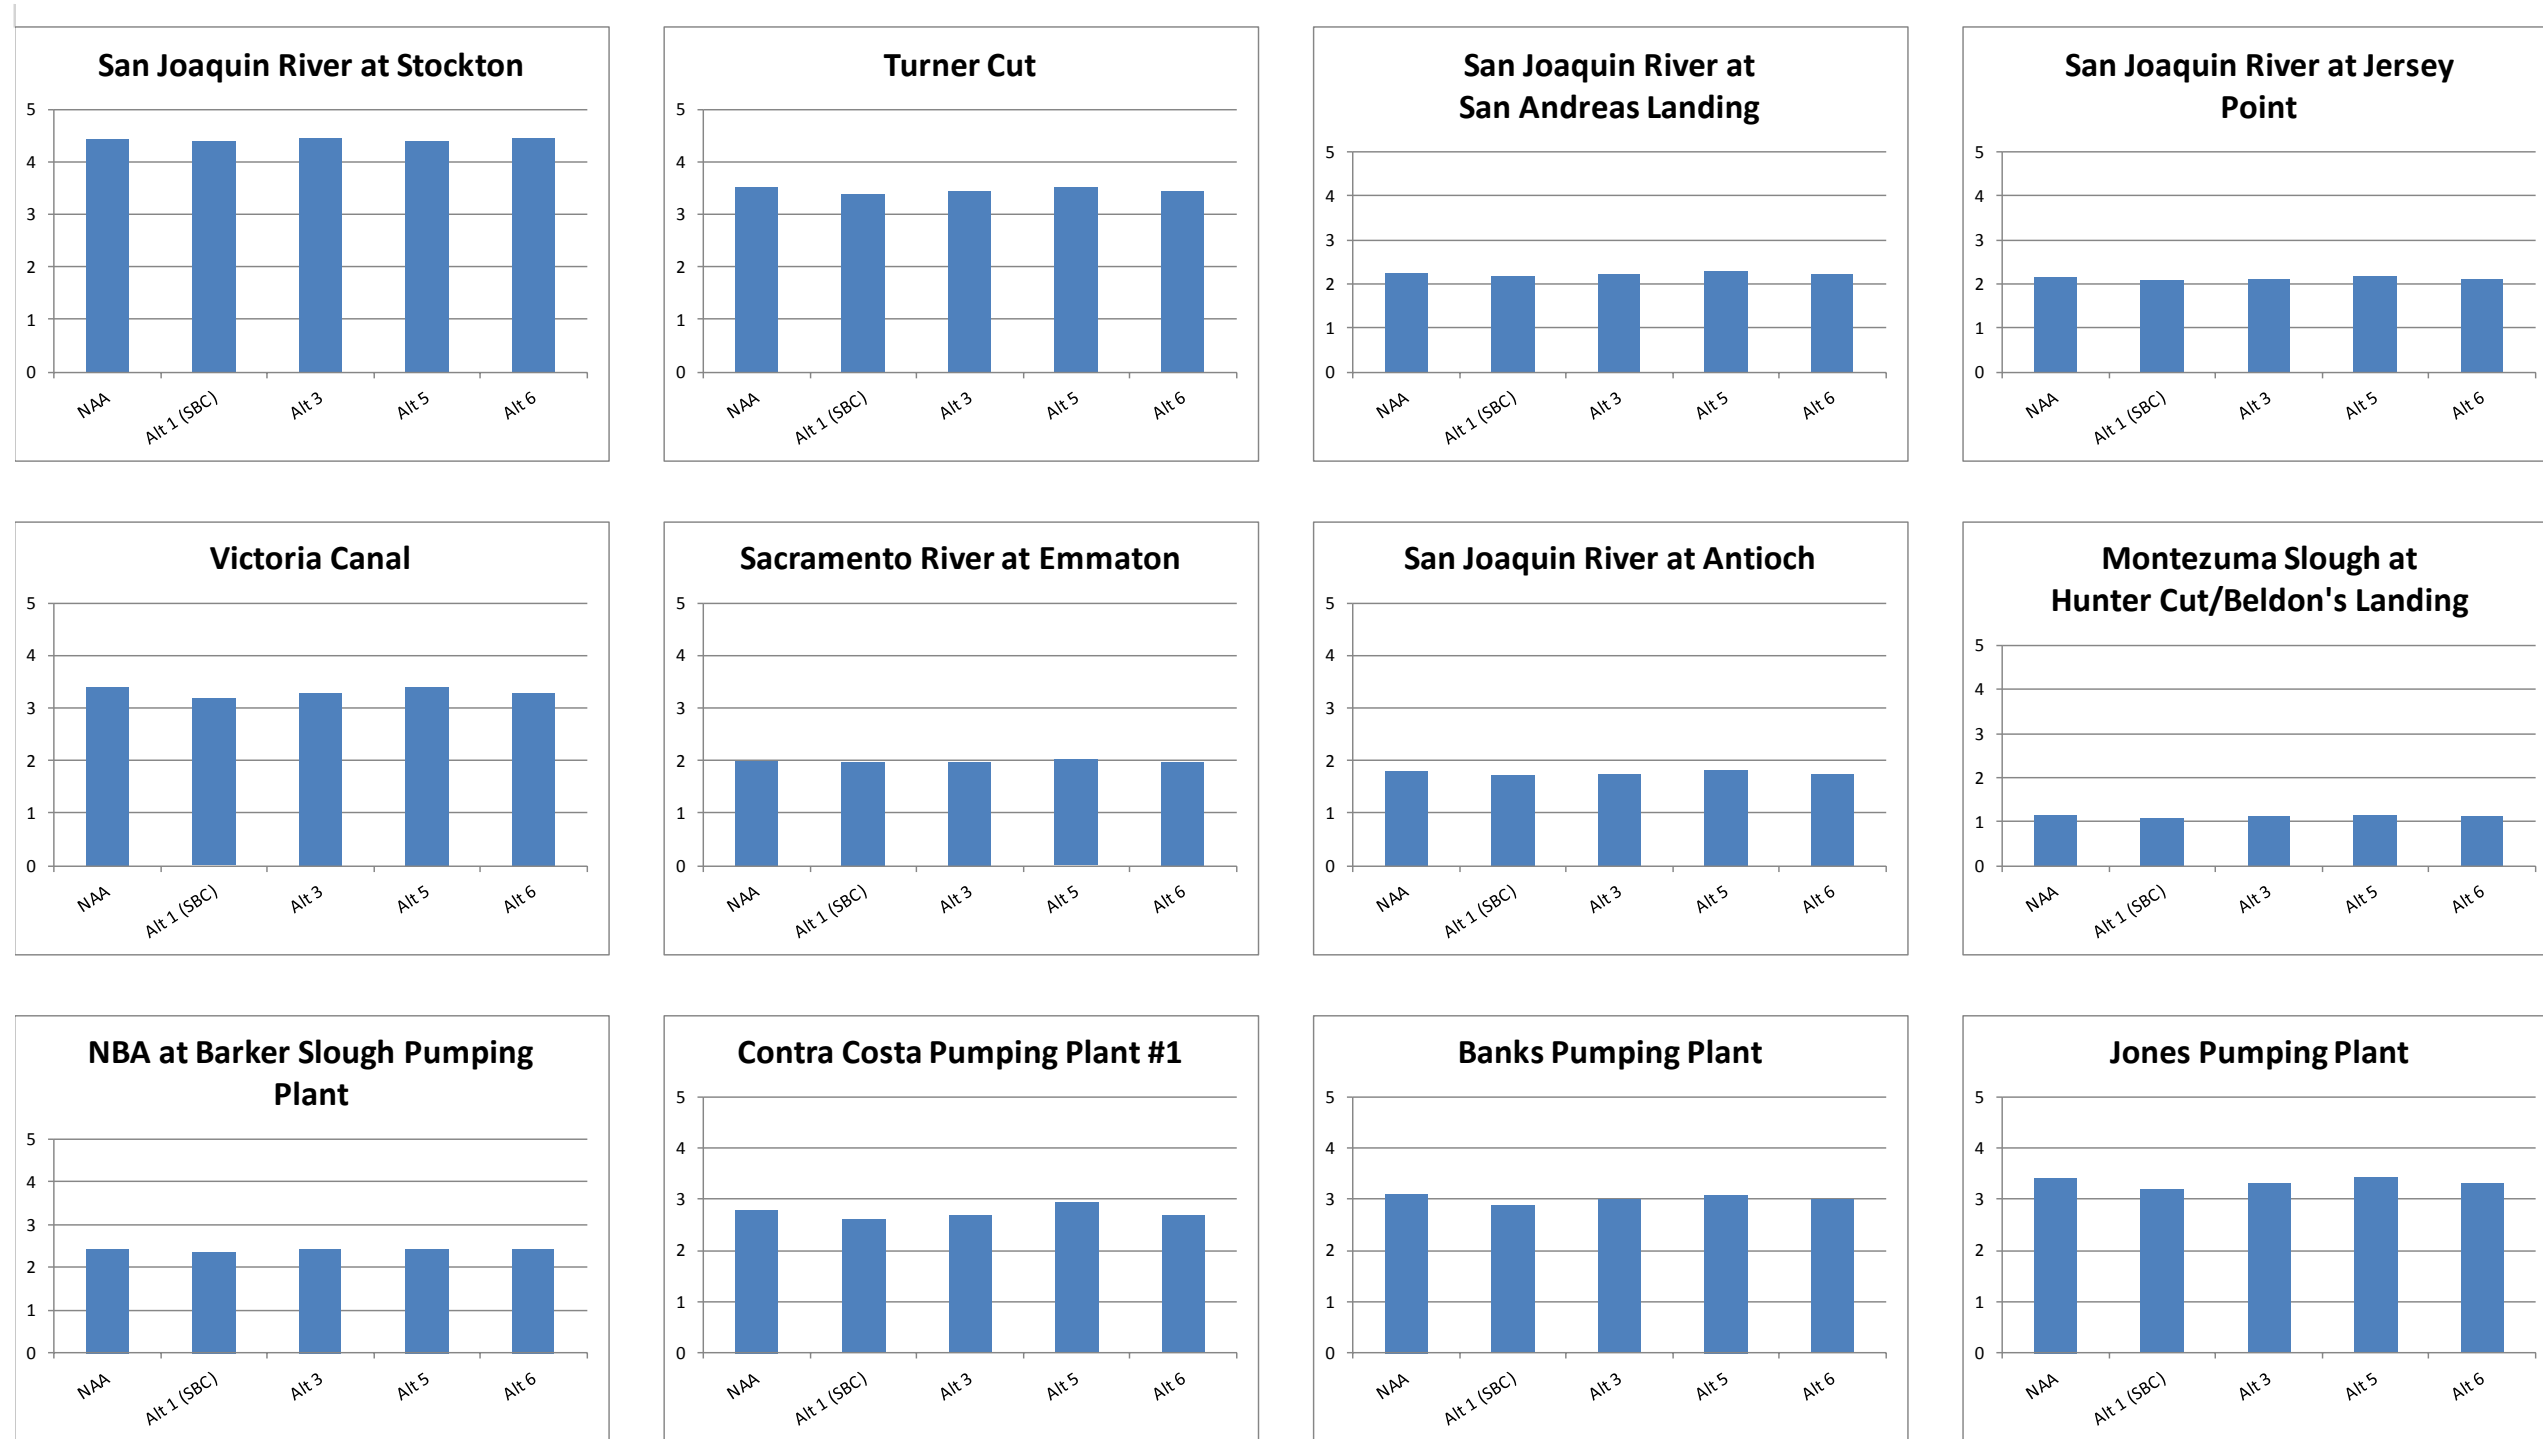

1

2 **Figure 6C.3. Level of Concern Exceedance Quotients for Mercury Concentrations in 350-mm Largemouth Bass Fillets for Drought Years**

1 Appendix 6D

2 Selenium Model Documentation

3 This appendix provides information about the methods, modeling tools, and
4 assumptions used for the Coordinated Long Term Operation of the Central Valley
5 Project (CVP) and State Water Project (SWP) Environmental Impact Statement
6 (EIS) analysis. This appendix also provides information pertaining to the
7 development of the analytical tools and the use of input data as well as model
8 result processing and interpretation methods used for the impacts analysis and
9 descriptions.

10 This appendix is organized into three main sections:

- 11 • Section 6D.1: Modeling Methodology
 - 12 – The selenium impacts analysis uses CalSim II, the Delta Simulation
 - 13 Model II (DSM2), and Delta-specific selenium bioaccumulation modeling
 - 14 to assess and quantify effects of the alternatives on the long-term
 - 15 operation and the environment. This section provides information about
 - 16 the development and calibration of a Delta-wide bioaccumulation model
 - 17 for selenium in fish, use of outputs from that model to estimate
 - 18 bioaccumulation in bird eggs and fish fillets, and modeling of selenium
 - 19 bioaccumulation in sturgeon living in the western Delta using inputs from
 - 20 other models.
- 21 • Section 6D.2: Modeling Simulations and Assumptions
 - 22 – This section provides a brief description of the assumptions for the
 - 23 selenium model simulations of the No Action Alternative, Second Basis of
 - 24 Comparison, and Alternatives 1 through 5.
- 25 • Section 6D.3: Modeling Results
 - 26 – This section provides a description of the model simulation output formats
 - 27 used in the analysis and interpretation of modeling results for the
 - 28 alternatives impacts assessment.

29 6D.1 Modeling Methodology

30 This section summarizes the selenium modeling methodology used for the No
31 Action Alternative, Second Basis of Comparison, and Alternatives 1 through 5. It
32 describes the overall analytical framework and development and use of
33 bioaccumulation models. This section also contains descriptions of the key
34 analytical and numerical tools and approaches used in the quantitative evaluation
35 of the alternatives. The project alternatives include changes to CVP and SWP
36 operation that would cause subsequent effects on the water quality of the system
37 relative to selenium. Those changes in waterborne selenium concentrations

1 would propagate to changes in selenium concentrations in fish and bird eggs
2 throughout the Delta.

3 **6D.1.1 Overview of the Modeling Approach and Objectives**

4 Modeling of flows, hydrodynamics, and selenium bioaccumulation in the Delta is
5 necessary to support the selenium impact analysis of alternatives. Impact analysis
6 focuses on evaluation of changes to selenium concentrations in tissues that affect
7 the health of fish as well as wildlife and humans consuming fish in the Delta.

8 CalSim II, DSM2, and bioaccumulation modeling were used in sequence to
9 estimate the effects of CVP and SWP operations on water quality relative to
10 selenium in the Delta. CalSim II, which simulates flow in California's
11 waterways, and DSM2, which simulates one-dimensional hydrodynamics in
12 California's Delta, are discussed in detail in Appendix 5A. One of the three
13 DSM2 modules, QUAL, simulates one-dimensional source tracking in the Delta.
14 Results from DSM2 were multiplied by source concentrations (shown in
15 Table 6D.1) to determine annual average waterborne selenium concentrations in
16 the Delta for all year types and drought years.

17 Operations-related changes in waterborne selenium concentrations in the Delta
18 may result in increased selenium bioaccumulation or toxicity (or both) to aquatic
19 and semi-aquatic receptors using the Delta. Historical fish tissue data from 2000,
20 2005, and 2007 (Foe 2010a) and measured (for Sacramento River below Knights
21 Landing and for San Joaquin River at Vernalis) or DSM2-modeled (other
22 locations) waterborne selenium concentrations for selected locations in 2000,
23 2005, and 2007 were used to model water-to-tissue relationships. This modeling
24 generally followed procedures described by Presser and Luoma (2010a, 2010b).
25 Implementation of the Grassland Bypass Project (GBP) has led to a 60 percent
26 decrease in selenium loads from the Grassland Drainage Area compared to pre-
27 project conditions (San Francisco Bay Regional Water Quality Control Board
28 2008). These changes are reflected in data for the San Joaquin River at Vernalis,
29 where water quality is monitored frequently because the river is a primary source
30 of selenium to the Delta. Vernalis water data for 2 years (1999-2000, 2004-2005,
31 and 2006-2007) were used for each year when fish data were available because of
32 the GBP-related changes and because the lag time for selenium bioaccumulation
33 in the piscivorous Largemouth Bass (*Micropterus salmoides*, the species for
34 which the Delta-wide bioaccumulation model was calibrated) may be more than
35 1 year (Beckon 2014).

36 Output from the DSM2-QUAL model (expressed as percentage of inflow from
37 different sources) was used in combination with the available measured
38 waterborne selenium concentrations (Table 6D.1) to model concentrations of
39 selenium at locations throughout the Delta. These modeled waterborne selenium
40 concentrations were used in the relationship model to estimate bioaccumulation of
41 selenium in whole-body fish and in bird eggs. Selenium concentrations in fish
42 fillets were then estimated from those in whole-body fish. The following sections
43 provide detailed information about the modeling approach for selenium.

1 **Table 6D.1 Selenium Concentrations in Water at Inflow Sources to the Delta**

Delta Sources	Representative Inflow Site	GM Se Concentration in Water ($\mu\text{g/L}$) ^a	Years	Source
Delta Agriculture	Mildred Island, Center	0.11	2000	Lucas and Stewart 2007
East Delta Tributaries	Mokelumne, Calaveras, and Cosumnes Rivers	0.10 ^b	None	None
Martinez/Suisun Bay	San Joaquin River near Mallard Island	0.10	02/2000–08/2008	SFEI 2014
Sacramento River	Sacramento River at Freeport	0.09	11/2007–07/2014	USGS 2014
San Joaquin River	San Joaquin River at Vernalis (Airport Way)	0.45 ^c	11/2007-08/2014	USGS 2014
San Joaquin River	San Joaquin River at Vernalis (Airport Way)	0.83 ^d	1999-2000	SWAMP 2009
		0.85	2004-2005	SWAMP 2009
		0.58	2006-2007	SWAMP 2009
Yolo Bypass	Sacramento River below Knights Landing	0.23 ^e	2004, 2007, 2008	DWR 2009

2

Notes:

3

a. Selenium concentrations are in dissolved fraction unless otherwise noted.

4

b. Dissolved selenium concentration is assumed to be 0.1 $\mu\text{g/L}$ due to lack of available data and lack of sources that would be expected to result in concentrations greater than 0.1 $\mu\text{g/L}$.

5

c. Data used to represent conditions for comparison of alternatives.

6

d. Not specified whether total or dissolved selenium; data for 1999-2000 used for bioaccumulation by bass in 2000; data for 2004-2005 for bass in 2005; and data for 2006-2007 for bass in 2007.

7

e. Total selenium concentration in water.

8

9

 $\mu\text{g/L}$ = microgram(s) per liter

10

GM = geometric mean

11

Se = selenium

12

13

In addition to the Delta-wide modeling for fish and birds (calibrated with data for Largemouth Bass), selenium uptake and food-chain transfer information from the ecosystem-scale selenium model for the San Francisco Bay-Delta Regional Ecosystem Restoration Implementation Plan (Presser and Luoma 2013) informed the selenium bioaccumulation model for the western Delta. The Largemouth Bass has lower selenium bioaccumulation rates than those observed for sturgeon (Green Sturgeon [*Acipenser medirostris*] and White Sturgeon, [*A. transmontanus*]) and is not an appropriate model species that would be protective of sturgeon. Sturgeon differ by feeding, in part, on Overbite Clams (*Corbula [Potamocorbula] amurensis*) in Suisun Bay and may do so in the western portion of the Delta under future conditions. Therefore, DSM2-modeled waterborne selenium concentrations from three western-most locations in the Delta (Sacramento River at Emmaton, San Joaquin River at Antioch, and

24

25

1 Montezuma Slough at Hunter Cut/Beldon’s Landing) were used to model
2 selenium bioaccumulation for sturgeon at those three locations to supplement the
3 modeling done for Largemouth Bass.

4 The results from this suite of physical and biological models are used to inform
5 the understanding of effects of each alternative considered in this EIS on
6 selenium. Modeling objectives included evaluation of the following:

- 7 • Percent changes in waterborne selenium concentrations under the alternatives
8 as compared to the No Action Alternative and the Second Basis of
9 Comparison
- 10 • Exceedances of fish, wildlife, or human thresholds for selenium effects

11 **6D.1.2 Key Components of the Selenium Modeling**

12 To fulfill the objectives of the selenium modeling effort, DSM2 output data were
13 used in combination with source water concentrations to estimate waterborne
14 selenium concentrations at representative locations throughout the Delta
15 (Tables 6D.2 through 6D.4, located at end of this appendix). Waterborne
16 selenium concentrations were then used to estimate tissue selenium
17 concentrations in Largemouth Bass (as a representative higher trophic-level fish)
18 throughout the Delta and in sturgeon in the western Delta. Estimation of
19 concentrations in Largemouth Bass throughout the Delta included the
20 development and calibration of a bioaccumulation model using measured
21 concentrations in bass (Foe 2010a). In contrast, modeling for sturgeon in the
22 western Delta relied on literature-based model parameters (Presser and Luoma
23 2013), because data were not available to further calibrate the model.

24 **6D.1.2.1 DSM2 Post-processing**

25 Dissolved or total selenium data were available for six inflow locations to the
26 Delta (Table 6D.1):

- 27 • Sacramento River below Knights Landing (just upstream of Yolo Bypass,
28 representing the Bypass source)
- 29 • Sacramento River at Freeport (mainstem flow to Delta)
- 30 • San Joaquin River at Vernalis (Airport Way) (mainstem flow to Delta)
- 31 • Mokelumne, Calaveras, and Cosumnes Rivers (for East Delta tributaries)
- 32 • Mildred Island, Center (for Delta Agriculture)
- 33 • San Joaquin River near Mallard Island (for Martinez/Suisun Bay)

34 Both dissolved and total selenium data were considered suitable for purposes of
35 the modeling conducted for the Delta, because they typically do not differ greatly.
36 Statements related to waterborne selenium concentrations in this appendix would
37 be applicable to either dissolved or total concentrations.

1 Whole-body Largemouth Bass data for selenium were available from the
2 following DSM2 output locations:

- 3 • Big Break
- 4 • Cache Slough Ryer
- 5 • Franks Tract
- 6 • Middle River Bullfrog
- 7 • Old River Near Paradise Cut
- 8 • Sacramento River Mile (RM) 44
- 9 • San Joaquin River Potato Slough

10 Largemouth Bass data also were available from the Veterans Bridge on the
11 Sacramento River and from Vernalis on the San Joaquin River, but DSM2 data
12 were not available for those locations; therefore, historical data for selenium
13 concentrations in water collected nearby (Table 6D.1) were used to represent
14 quarterly averages. The geometric mean of total selenium concentrations in water
15 collected from the Sacramento River below Knights Landing in 2004, 2007, and
16 2008 (DWR 2009) were used to represent quarterly averages of selenium
17 concentrations in water for Veterans Bridge in all years. The geometric means of
18 selenium concentrations (total or dissolved was not specified) in water collected
19 from 1999–2000, 2004-2005, and 2006-2007 (SWAMP 2009) were used to
20 represent quarterly averages for selenium concentrations in water at Vernalis
21 during 2000, 2005, and 2007, respectively.

22 For DSM2 output locations, the geometric mean selenium concentrations from the
23 inflow locations were combined with the modeled quarterly average percent
24 inflow for each DSM2 output location to estimate waterborne selenium
25 concentrations at those locations. The quarterly average mix of water from the six
26 inflow sources (Table 6D.1) was calculated from daily percent inflows provided
27 by the DSM2 model output for the DSM2 output locations for which fish data
28 were available. The quarterly waterborne selenium concentrations at DSM2
29 locations were calculated using Equation 1:

$$30 \quad C_{water \text{ quarterly}} = ([I_1 * C_1] + [I_2 * C_2] + [I_3 * C_3] + [I_4 * C_4] + [I_5 * C_5] + [I_6 * C_6]) / 100$$

31 Where:

- 32 • $C_{water \text{ quarterly}}$ = quarterly average selenium concentration in water
33 (micrograms/liter [$\mu\text{g/L}$]) at a DSM2 output location
- 34 • I_{1-6} = modeled quarterly inflow from each of the six sources of water to the
35 Delta for each DSM2 output location (percentage)
- 36 • C_{1-6} = selenium concentration in water ($\mu\text{g/L}$) from each of the six inflow
37 sources to the Delta (1-6)

1 Example Calculation: Modeled Selenium Concentration at Franks Tract Year
 2 2000, First Quarter:

3 (43.94 [% inflow from Sacramento River water source at Franks Tract]
 4 × 0.09 µg/L [selenium concentration at Sacramento River at Freeport]) +
 5 (11.56 [% inflow from East Delta Tributaries water source at Franks Tract]
 6 × 0.10 µg/L [selenium concentration at Mokelumne, Calaveras, and
 7 Cosumnes Rivers]) + (15.79 [% inflow from San Joaquin River water source
 8 at Franks Tract] × 0.83 µg/L [selenium concentration at San Joaquin River at
 9 Vernalis]) + (0.02 [% inflow from Martinez/Suisun Bay water source at
 10 Franks Tract] × 0.10 µg/L [selenium concentration at San Joaquin River near
 11 Mallard Island]) + (0.32 [% inflow from Yolo Bypass water source at Franks
 12 Tract] × 0.23 µg/L [selenium concentration at Sacramento River below
 13 Knights Landing]) + (5.06 [% inflow from Delta Agriculture water source at
 14 Franks Tract] × 0.11 µg/L [selenium concentration at Mildred Island,
 15 Center])/100 = 0.19 µg/L

16 The quarterly and average annual waterborne selenium concentrations for the
 17 DSM2 output locations are shown in Table 6D.2 (Year 2000), Table 6D.3
 18 (Year 2005), and Table 6D.4 (Year 2007).

19 **6D.1.2.2 Delta-wide Selenium Model Development**

20 Selenium concentrations in whole-body fish and in bird eggs were calculated
 21 using ecosystem-scale models developed by Presser and Luoma (2010a, 2010b,
 22 2013). The models were based on biogeochemical and physiological factors from
 23 laboratory and field studies; loading rates, chemical speciation, and
 24 transformation to particulate material; bioavailability; bioaccumulation in
 25 invertebrates; and trophic transfer to predators. Important components of the
 26 methodology included (1) empirically determined environmental partitioning
 27 factors between water and particulate material that quantify the effects of
 28 dissolved speciation and phase transformation; (2) concentrations of selenium in
 29 living and non-living particulates at the base of the food web that determine
 30 selenium bioavailability to invertebrates; and (3) selenium biodynamic food web
 31 transfer factors that quantify the physiological potential for bioaccumulation from
 32 particulate matter to consumer organisms and from prey to their predators.

33 **6D.1.2.2.1 Selenium Concentration in Particulates**

34 Phase transformation reactions from dissolved to particulate selenium are the
 35 primary form by which selenium enters the food web. Presser and Luoma (2010a,
 36 2010b, 2013) used field observations to quantify the relationship between
 37 particulate material and dissolved selenium as indicated in Equation 2.

$$C_{particulate} = K_d * C_{water\ column}$$

39 Where:

- 40 • $C_{particulate}$ = selenium concentration in particulate material
 41 (micrograms/kilogram, dry weight [µg/kg dw])
- 42 • K_d = particulate/water ratio
- 43 • $C_{water\ column}$ = selenium concentration in water column (µg/L)

1 The K_d (also called an “enrichment factor”) describes the particulate/water ratio at
 2 the moment the sample was taken and should not be interpreted as an equilibrium
 3 constant (as it sometimes is mistaken to be). It can vary widely among hydrologic
 4 environments and potentially among seasons (Presser and Luoma 2010a, 2010b,
 5 2013; Young et al. 2010). In addition, other factors such as selenium speciation,
 6 water residence time, and particle type affect K_d . Selenium typically enters a
 7 stream primarily as selenate. If the stream flows into a wetland and the water is
 8 retained there with sufficient residence time, recycling of selenium may occur.
 9 This results in generation of particulate selenium and conversion to more
 10 bioaccumulative selenite and organo-selenium from the less-bioaccumulative
 11 dissolved selenate. Residence time of water containing selenium is usually the
 12 most influential factor on the conditions in the receiving aquatic environment.
 13 Short water residence times (such as in streams and rivers) limit partitioning of
 14 selenium into particulate material. Conversely, longer residence times (such as in
 15 sloughs, lakes, and estuaries) allow greater uptake by plants, algae, and
 16 microorganisms. Furthermore, environments in downstream portions of a
 17 watershed can receive cumulative contributions of upstream recycling in a
 18 hydrologic system. Because of its high variability, K_d is a large source of
 19 uncertainty in any selenium model where extrapolations from selenium
 20 concentrations in the water column to those in aquatic organism tissues, or from
 21 tissue to waterborne concentrations, are necessary.

22 In developing the Delta-wide bioaccumulation model for bass, the particulate
 23 selenium concentration initially was estimated using Equation 2 and a default K_d
 24 of 1,000 (Presser and Luoma 2010a). Because the K_d is typically much more
 25 variable than other steps in the bioaccumulation model, the K_d was then adjusted
 26 to calibrate the model so that the modeled concentrations for fish approximated
 27 the measured concentrations in bass for normal and wet years (2000 and 2005)
 28 and for drought years (2007), as described in more detail in Section 6D.1.2.3.

29 **6D.1.2.2.2 Selenium Concentrations in Invertebrates**

30 Trophic transfer factors (TTFs) for transfer of selenium from particulates to prey
 31 and to predators were developed using data from laboratory experiments and field
 32 studies (Presser and Luoma 2010a, 2010b, 2013). TTFs are species-specific, but
 33 the range of TTFs for freshwater invertebrates was found to be similar to TTFs for
 34 marine invertebrates determined in laboratory experiments.

35 TTFs for estimating selenium concentrations in invertebrates were calculated
 36 using Equation 3:

$$37 \quad TTF_{invertebrate} = (C_{invertebrate}) / (C_{particulate})$$

38 Where:

- 39 • $TTF_{invertebrate}$ = trophic transfer factor from particulate material to invertebrate
- 40 • $C_{invertebrate}$ = concentration of selenium in invertebrate ($\mu\text{g/g dw}$)
- 41 • $C_{particulate}$ = concentration of selenium in particulate material ($\mu\text{g/g dw}$)

1 An average aquatic insect TTF was calculated from TTFs for aquatic insect
 2 species with similar bioaccumulative potential, including Mayfly (*Baetidae*;
 3 *Heptageniidae*; *Ephemerellidae*), Caddisfly (*Rhyacophilidae*; *Hydropsychidae*),
 4 Crane Fly (*Tipulidae*), Stonefly (*Perlodidae*/*Perlidae*; *Chloroperlidae*),
 5 Damselfly (*Coenagrionidae*), Corixid (*Cenocorixa* sp.), and Chironomid
 6 (*Chironomus* sp.) aquatic life stages. Species-specific TTFs ranged from 2.1 to
 7 3.2; the average TTF of 2.8 was used in the Delta-wide model.

8 **6D.1.2.2.3 Selenium Concentrations in Whole-body Fish**

9 The mechanistic equation for modeling of selenium bioaccumulation in fish tissue
 10 is similar to that for invertebrates if whole-body concentrations are the endpoint
 11 (Presser and Luoma 2010a, 2010b, 2013), as shown in Equation 4:

$$12 \quad TTF_{fish} = C_{fish} / C_{invertebrate}$$

13 where:

$$14 \quad C_{invertebrate} = C_{particulate} * TTF_{invertebrate}$$

15 therefore:

$$16 \quad C_{fish} = C_{particulate} * TTF_{invertebrate} * TTF_{fish}$$

17 Where:

- 18 • C_{fish} = concentration of selenium in fish ($\mu\text{g/g dw}$)
- 19 • $C_{particulate}$ = concentration of selenium in particulate material ($\mu\text{g/g dw}$)
- 20 • $C_{invertebrate}$ = concentration of selenium in invertebrate ($\mu\text{g/g dw}$)
- 21 • $TTF_{invertebrate}$ = trophic transfer factor from particulate material to invertebrate
- 22 • TTF_{fish} = trophic transfer factor from invertebrate to fish

23 Modeling selenium bioaccumulation into a particular fish species considers
 24 organism physiology and its preferred foods. However, variability in fish tissue
 25 selenium concentrations for present modeling purposes is driven more by dietary
 26 choices and their respective levels of bioaccumulation (that is, $TTF_{invertebrate}$)
 27 than by differences in fish physiology or the dietary transfer to the fish (TTF_{fish}).
 28 A diet of mixed prey (including invertebrates or other fish) can be modeled as
 29 shown in Equation 5:

$$30 \quad C_{fish} = TTF_{fish} * ([C_1 * F_1] + [C_2 * F_2] + [C_3 * F_3])$$

31 Where:

- 32 • C_{fish} = concentration of selenium in fish ($\mu\text{g/g dw}$)
- 33 • TTF_{fish} = trophic transfer factor for fish species
- 34 • C_{1-3} = concentration of selenium in invertebrate or fish prey items 1, 2, and 3
 35 ($\mu\text{g/g dw}$)
- 36 • F_{1-3} = fraction of diet composed of prey items 1, 2, and 3

37 Modeling of selenium concentrations in longer food webs with higher trophic
 38 levels (for example, predator fish such as bass consuming forage fish) can be
 39 completed by incorporating additional TTFs, as shown in Equation 6:

$$C_{predatorfish} = C_{particulate} * TTF_{invertebrate} * TTF_{foragefish} * TTF_{predatorfish}$$

2 Where:

- 3 • $C_{predatorfish}$ = concentration of selenium in fish ($\mu\text{g/g dw}$)
- 4 • $C_{particulate}$ = concentration of selenium in particulate material ($\mu\text{g/g dw}$)
- 5 • $TTF_{invertebrate}$ = trophic transfer factor from particulate material to invertebrate
- 6 • $TTF_{foragefish}$ = trophic transfer factor for invertebrates to foraging fish species
- 7 • $TTF_{predatorfish}$ = trophic transfer factor for forage fish to predator species

8 The fish TTFs reported in Presser and Luoma (2010a) ranged from 0.5 to 1.6, so
9 the average fish TTF of 1.1 was used for all trophic levels of fish in the Delta-
10 wide model.

11 Modeled selenium concentrations in whole-body fish were used to estimate
12 selenium concentrations in fish fillets, as described in Section 6D.1.2.2.5.

13 **6D.1.2.2.4 Selenium Concentrations in Bird Eggs**

14 Selenium concentrations in bird tissues can be estimated, but the transfer of
15 selenium into bird eggs is more meaningful for evaluating reproductive endpoints
16 (Presser and Luoma 2010a; Ohlendorf and Heinz 2011). Examples of models for
17 selenium transfer to bird eggs are as shown in Equations 7 and 8:

$$18 \quad C_{birdegg} = C_{particulate} * TTF_{invertebrate} * TTF_{birdegg}$$

19 (this equation is based on birds, such as shorebirds, eating invertebrates)

20 or:

$$21 \quad C_{birdegg} = C_{particulate} * TTF_{invertebrate} * TTF_{fish} * TTF_{birdegg}$$

22 (this equation is based on birds, such as herons or terns, feeding on small fish)

23 Where:

- 24 • $C_{birdegg}$ = concentration of selenium in bird egg ($\mu\text{g/g dw}$)
- 25 • $C_{particulate}$ = concentration of selenium in particulate material ($\mu\text{g/g dw}$)
- 26 • $TTF_{invertebrate}$ = trophic transfer factor from particulate material to invertebrate
- 27 • TTF_{fish} = trophic transfer factor from invertebrate to fish
- 28 • $TTF_{birdegg}$ = trophic transfer factor from invertebrate or fish (depending on
29 diet) to bird egg

30 Presser and Luoma (2010b, 2013) reviewed the available data for selenium
31 bioaccumulation from diet to bird eggs and concluded that the mean $TTF_{birdegg} =$
32 2.6 was most appropriate for modeling. This TTF was based on laboratory
33 studies in which Mallards (*Anas platyrhynchos*) were fed selenium-fortified diets
34 to evaluate reproductive effects. Mallards are considered a sensitive species to
35 selenium based on reproductive endpoints. In their previous evaluation of those
36 data, Presser and Luoma (2010a) concluded that a $TTF_{birdegg} = 1.8$ was
37 appropriate. The form of selenium included in the Mallard diet
38 (selenomethionine) has been used as a surrogate in many laboratory studies to
39 represent exposure of fish and birds under field conditions. Other laboratory
40 studies were conducted with Black-crowned Night-herons (*Nycticorax*

1 *nycticorax* by Smith et al (1988), for Eastern Screech-owls (*Otus asio*) by
 2 Wiemeyer and Hoffman (1996), and for American Kestrels (*Falco sparverius*) by
 3 Santolo et al. (1999). In each of these studies, the experimental groups also
 4 received supplemental selenium in the form of selenomethionine. Transfer
 5 factors for the selenium-supplemented birds varied from approximately 1.0 to 2.2,
 6 with a mean of 1.5.

7 In field studies conducted at Kesterson Reservoir and the Volta Wildlife Area
 8 reference site, extensive sampling of food-chain biota and bird eggs was
 9 conducted from 1983 through 1985, and birds were collected to determine
 10 qualitatively the kinds of aquatic organisms they had eaten (Saiki and Lowe 1987;
 11 Hothem and Ohlendorf 1989; Schuler et al. 1990; Ohlendorf and Hothem 1995).
 12 Based on the kinds of food items found in each of the sampled species and the
 13 mean selenium concentrations in those kinds of organisms, a mean selenium
 14 concentration was estimated for each species at each site during each nesting
 15 season. In contrast to the findings with selenomethionine-supplemented diets in
 16 the laboratory, TTFs from diet to eggs were almost always less than 2.0. At the
 17 Volta Wildlife Area, where diet and egg selenium concentrations were
 18 representative of “background” conditions, transfer factors ranged from 0.63 to
 19 2.0, with a mean of 1.35. At Kesterson, the transfer factors ranged from less than
 20 0.2 to 0.48.

21 Because selenomethionine in the Mallard diet is probably more readily transferred
 22 to eggs than are the selenium forms in field-collected food-chain biota, the
 23 $TTF_{bird\text{egg}} = 1.8$ value from Presser and Luoma (2010a) was used in the
 24 bioaccumulation model.

25 **6D.1.2.2.5 Selenium Concentrations in Fish Fillets**

26 Selenium concentrations in whole-body fish from the bioaccumulation model
 27 were converted to selenium concentrations in skinless fish fillets for evaluation of
 28 potential human health effects. The regression equation provided in Saiki et al.
 29 (1991) for Largemouth Bass from the San Joaquin River system was considered
 30 to be the most representative of fish in the Delta and was used for the conversion
 31 of these selenium concentrations as shown in Equation 9:

$$32 \quad SF = (-0.388) + (1.322 * WB)$$

33 Where:

- 34 • SF = selenium concentration in skinless fish fillet ($\mu\text{g/g dw}$)
- 35 • WB = selenium concentration in whole-body fish ($\mu\text{g/g dw}$)

36 For the impact assessment in this EIS, fish fillet data were compared to the
 37 Advisory Tissue Level (2.5 micrograms per gram [$\mu\text{g/g}$] in wet weight (ww)
 38 (OEHHA 2008); therefore, wet-weight concentrations were estimated from dry-
 39 weight concentrations using the equation provided by Saiki et al. (1991) as shown
 40 in Equation 10:

$$41 \quad WW = DW * (100 - Moist)/100$$

1 Where:

- 2 • WW = selenium concentration in wet weight ($\mu\text{g/g ww}$)
- 3 • DW = selenium concentration in dry weight ($\mu\text{g/g dw}$)
- 4 • $Moist$ = mean moisture content of the species

5 Because moisture content in fish varies among species, sample handling, and
6 locations, the mean moisture content of 70 percent used by Foe (2010b) was used
7 as an assumed approximation for fish in the Delta. The final equation used to
8 estimate selenium concentration in skinless fish fillets (wet weight) from selenium
9 concentration in whole-body fish (dry weight) is as shown in Equation 11:

$$10 \quad SF = ([-0.388] + [1.322 * WB]) * 0.3$$

11 Where:

- 12 • SF = selenium concentrations in skinless fish fillet ($\mu\text{g/g ww}$)
- 13 • WB = selenium concentration in whole-body fish ($\mu\text{g/g dw}$)

14 **6D.1.2.3 Delta-wide Selenium Model Calibration**

15 Several models were evaluated and refined to estimate selenium uptake in fish
16 and in bird eggs from waters in the Delta. Input parameters to the model (K_d s
17 and the number of trophic levels) were varied among the models as refinements were
18 made. Data for Largemouth Bass collected in the Delta from areas near DSM2
19 output locations were used to calculate the geometric mean selenium
20 concentration in whole-body fish (Foe 2010a). The ratio of the estimated
21 (modeled) selenium concentration in fish to measured selenium in whole-body
22 bass was used to evaluate each fish model and to focus refinements of the model.
23 These Delta-wide models are presented in the following subsections.

24 Characteristics of water flow in the Delta affect selenium bioaccumulation and the
25 model refinements, because longer residence time for the water can be expected
26 to increase bioaccumulation by increasing K_d . Foe (2010a) reported the water
27 year type for 2000 as “above normal” for both the Sacramento River and San
28 Joaquin River watersheds. It came after “wet” water years and was followed by
29 “dry” water years. Year 2005 was wetter than 2000, was reported as “above
30 normal” for the Sacramento River watershed and “wet” for the San Joaquin River
31 watershed. Year 2005 occurred between periods of wet water years. Water Year
32 2007 was reported as “dry” (Sacramento River watershed) and “critically dry”
33 (San Joaquin River watershed). It came after wet water years and was followed
34 by critically dry water years.

35 There was no difference in bass selenium concentrations in the Sacramento River
36 at Rio Vista in comparison to the San Joaquin River at Vernalis in 2000, 2005,
37 and 2007 (Foe 2010a). The lack of a difference in bioaccumulated selenium
38 between the two river systems was unexpected because the San Joaquin River is
39 considered a significant source of selenium to the Delta. There were differences
40 among years, however, that were related to hydrology and water flow through the
41 Delta. Year 2005 selenium concentrations in bass were comparatively lower than
42 those estimated for Year 2000. As expected in a wet water year, the water
43 residence time was shorter, resulting in less selenium recycling, lower K_d values,

1 and lower concentrations of selenium entering the food web. The dry water year
 2 (2007) resulted in a longer water residence time, higher K_d values, greater
 3 selenium recycling, and higher concentrations of bioavailable selenium entering
 4 the food web. These differences among years were considered when refining the
 5 selenium bioaccumulation model.

6 **6D.1.2.3.1 Bioaccumulation in Whole-body Fish**

7 Models estimating whole-body selenium concentrations in fish were refined by
 8 modifying dietary composition and input parameters to closely represent
 9 measured conditions in the Delta. Each model is described in this section.

10 Model 1 was a basic representative of uptake by a forage fish, while Model 2
 11 calculated sequential bioaccumulation in a more complex food web that included
 12 predatory fish eating forage fish, as shown below:

13 Model 1: Trophic level 3 (TL-3) fish eating invertebrates (Equation 12):

$$14 \quad C_{fish} = C_{particulate} * TTF_{invertebrate} * TTF_{fish}$$

15 Model 2: Trophic level 4 (TL-4) fish eating TL-3 fish (Equation 13):

$$16 \quad C_{predatorfish} = C_{particulate} * TTF_{invertebrate} * TTF_{foragefish} * TTF_{predatorfish}$$

17 Where:

- 18 • C_{fish} = concentration of selenium in fish ($\mu\text{g/g dw}$)
- 19 • $C_{particulate}$ = concentration of selenium in particulate material ($\mu\text{g/g dw}$)
- 20 • $TTF_{invertebrate}$ = Trophic transfer factor from particulate material to invertebrate
- 21 • TTF_{fish} = Trophic transfer factor from invertebrate to forage fish or forage fish
 22 to predator fish

23 Equation 12 is the same as Equation 4 and Equation 13 is the same as Equation 6
 24 that were described previously for the generalized model. In both Models 1 and
 25 2, the particulate selenium concentration was estimated using Equation 2 and a
 26 default K_d of 1,000. The average TTFs for invertebrates (2.8) and fish (1.1) were
 27 used in each model. The outputs of estimated selenium concentrations and the
 28 ratios of predicted-to-observed bass selenium concentrations for Models 1 and 2
 29 are presented in Table 6D.5 and Figure 6D.1 (all figures are provided at the end of
 30 this appendix).

31 Models 1 and 2 tended to substantially underestimate the whole-body selenium
 32 concentrations in fish compared to bass data reported in Foe (2010a). This was
 33 partly because Model 1 was estimating selenium concentration in a forage fish
 34 (TL-3), whereas bass are a predatory fish with expected higher dietary exposure.
 35 Consequently, Model 1 was not further developed as the selenium
 36 bioaccumulation model to represent fish in the Delta.

37 Model 2 is representative of predatory fish, but Model 2 was very similar to
 38 Model 1 in distribution of data and in underestimating bass data, even though an
 39 additional trophic-level transfer was included in the model. As noted in Section
 40 6D.1.2.2.1 and described in much greater detail by Presser and Luoma (2010a,
 41 2010b, 2013), the K_d values for uptake from water are far more variable than the

1 TTFs for invertebrates or fish. Models 1 and 2 also apparently reflect the
2 tendency of selenium (as an essential nutrient) to be more bioaccumulative when
3 waterborne concentrations are low (as described by Stewart et al. [2010]), which
4 they were for the DSM2-modeled concentrations (that is, 0.09 to 0.85 $\mu\text{g/L}$).
5 Available K_d values from various sampling efforts in the Delta provided by
6 Presser and Luoma (2010b) were reviewed for potential applicability in the
7 modeling effort. Those values varied on the basis of locations within the Delta
8 and Suisun Bay and also by water year and flow characteristics (often greater than
9 5,000 and sometimes exceeding 10,000). However, efforts to incorporate various
10 selected K_d values (for example, 2,000 or 3,000) into the model uniformly for
11 different DSM2 locations failed to produce ratios of modeled-to-measured fish
12 selenium concentrations that approximated 1 (they either over- or underestimated
13 fish selenium concentrations because of variability in site conditions).

14 The available bass data and the assumed TTFs for invertebrates (2.8) and fish
15 (1.1) were used to back-calculate a location and sample-specific K_d . It is
16 recognized that some of the variability in bioaccumulation may be associated with
17 the TTFs, but there were no reasonable assumptions for selection of alternative
18 values to plug into the model.

19 When TTFs were held constant, back-calculation of K_d values revealed a
20 concentration-related influence on the values. For waterborne selenium
21 concentrations in the range of 0.09 to 0.13 $\mu\text{g/L}$ ($N = 50$), the median was 5,575;
22 when waterborne selenium concentrations were in the range of 0.14 to 0.40 $\mu\text{g/L}$
23 ($N = 19$), the median K_d was 2,431; for waterborne selenium concentrations in the
24 range of 0.41 to 0.85 $\mu\text{g/L}$ ($N = 19$), the median K_d was 748. These observations
25 are consistent with an inverse relationship between waterborne selenium
26 concentrations and bioaccumulation in aquatic organisms (Stewart et al. 2010).

27 Figure 6D.2 shows the log-log regression relation of K_d to waterborne selenium
28 concentration when all years are included and the TTFs are held constant, while
29 Figure 6D.3 shows the relationship for normal/wet years (2000 and 2005) and
30 Figure 6D.4 shows the regression for dry years (2007), when the K_d s were
31 generally higher.

32 Model 3 is based on Model 2 (with TTFs as described previously) but includes the
33 K_d estimated from the log-log regression relation for all years (Figure 6D.2). This
34 produced a median ratio of predicted-to-observed whole-body selenium in bass
35 that slightly exceeded 1 (Figure 6D.1); details are provided in Table 6D.6.
36 Because of the noticeable differences between 2007 (the dry year) and the other
37 2 years, the next step in modeling was to evaluate 2007 separately from 2000
38 and 2005.

39 Model 4 was developed using the log-log relationship between K_d and water
40 selenium concentrations for 2000 and 2005 (Figure 6D.3). Model 5 was
41 developed using log-log relationship between K_d and water selenium
42 concentrations for 2007 (Figure 6D.4 and Table 6D.7). These two models
43 produced ratios of predicted-to-observed whole-body selenium in bass
44 approximating 1, as shown in Figure 6D.1.

1 As expected in a large, complex, and diverse ecological habitat such as the Delta,
2 variations in the data distribution and in the outputs of the models are not
3 surprising. However, it should be noted that the estimated K_d values for Model 3
4 (674-6,060; Table 6D.6), Model 4 (651-4,997; Table 6D.7), and Model 5
5 (1,206-8,064; Table 6D.7) are consistent with those summarized by Presser and
6 Luoma (2010b) for the Delta.

7 Figures 6D.5 and 6D.6 illustrate the distribution of data for selenium
8 concentrations in Largemouth Bass (Foe 2010a) relative to the measured or
9 DSM2-modeled waterborne selenium concentrations (Tables 6D.1 through 6D.4)
10 and Models 3, 4, and 5 to complement the boxplots shown in Figure 6D.1. There
11 is notably more variability in selenium concentrations in bass between 0.09 and
12 0.13 $\mu\text{g/L}$ than at higher waterborne selenium concentrations (as shown in both
13 Figures 6D.5 and 6D.6); most of the higher values are from 2007 and most of the
14 lower ones are from 2005.

15 Figure 6D.5 shows the available data for 2000, 2005, and 2007 plotted with the
16 Model 3 prediction of selenium concentrations. As noted previously in text and in
17 Figure 6D.1, the model slightly over-predicts the median concentrations in fish on
18 the basis of waterborne selenium concentrations. This effect is reflected in
19 Figure 6D.1 by the outliers above the 90th percentile bar (that is, the higher over-
20 predictions for fish, which are those from 2000 and 2005). However, overall, the
21 model is within 1 $\mu\text{g/g}$ for all values less than the prediction, and within
22 approximately 1.2 $\mu\text{g/g}$ for the values greater than the prediction (Figure 6D.5).

23 Because of the notable differences between data for 2007 compared to combined
24 2000 and 2005 data, Model 4 was developed for 2000 and 2005 and Model 5 was
25 developed for 2007, Figure 6D.6 shows those model predictions compared to the
26 data. These two models improved the predictions; although the figure shows
27 more differences between data and the models at the lower waterborne
28 concentrations (that is, less than 0.30 $\mu\text{g/L}$) than at higher ones, the divergence is
29 generally less than 0.5 $\mu\text{g/g}$ at the higher waterborne concentrations. The outliers
30 for Model 4 are mostly above the 90th percentile (that is, over-predicting
31 concentrations in fish), rather than below, as shown in Figure 6D.1. For Model 5,
32 the predictions are “tighter” with just a few outliers above or below the
33 90th percentile.

34 Evaluation of water-year effects on selenium concentration in bass concluded that
35 Model 4 was relatively predictive of selenium concentration in whole-body bass
36 during normal to wet water years. Model 5 was considered predictive for dry
37 water years (such as 2007). Model 3 incorporates the varying bioaccumulation
38 when all years are considered (that is, 2000, 2005, and 2007). Although Model 3
39 tends to slightly overestimate selenium bioaccumulation (Table 6D.6 and
40 Figure 6D.1), it was used for estimating selenium concentrations in whole-body
41 fish in the impact assessment for “All” years, and Model 5 was used for
42 “Drought” years.

1 **6D.1.2.3.2 Selenium Bioaccumulation in Bird Eggs**

2 The K_d , invertebrate TTF, and fish TTFs developed for use in fish
3 bioaccumulation Models 4 and 5 were also used to estimate selenium uptake into
4 bird eggs using the following two bird egg models (Table 6D.8):

5 Bird Egg: Uptake from invertebrates (Equation 14):

$$6 \quad C_{birdegg} = C_{particulate} * TTF_{invertebrate} * TTF_{birdegg}$$

7 where:

$$8 \quad C_{particulate} = K_d * C_{water}$$

9 Bird Egg: Uptake from fish (Equation 15):

$$10 \quad C_{birdegg} = C_{particulate} * TTF_{invertebrate} * TTF_{fish} * TTF_{fish} * TTF_{birdegg}$$

11 where:

$$12 \quad C_{particulate} = K_d * C_{water}$$

13 Where:

- 14 • $C_{birdegg}$ = concentration of selenium in bird egg ($\mu\text{g/g dw}$)
- 15 • $C_{particulate}$ = concentration of selenium in particulate material ($\mu\text{g/g dw}$)
- 16 • C_{water} = selenium concentration in water column ($\mu\text{g/L}$)
- 17 • K_d = particulate/water ratio
- 18 • $TTF_{invertebrate}$ = trophic transfer factor from particulate material to invertebrate
- 19 • TTF_{fish} = trophic transfer factor from invertebrate or fish to fish
- 20 • $TTF_{birdegg}$ = trophic transfer factor from invertebrate or fish (depending on
21 diet) to bird egg

22 Equation 14 is the same as Equation 7, but Equation 15 differs from Equation 8 in
23 that it assumes birds are eating larger predatory fish such as bass.

24 **6D.1.2.4 Western Delta Sturgeon Model**

25 Presser and Luoma (2013) determined K_d values for San Francisco Bay (including
26 Carquinez Strait – Suisun Bay) during “low flow” conditions (5,986) and
27 “average” conditions (3,317). These values were used to model selenium
28 concentrations in particulates in bioaccumulation modeling for sturgeon under
29 “Drought” and “All” year conditions at the three locations in the western Delta.
30 (By comparison, calibration of the Delta-wide model for two western-most
31 location from which bass had been collected [Big Break] resulted in an average
32 $K_d = 3,736$ for 2000/2005 [Model 4, normal/wet years] and average $K_d =$
33 $7,166$ for 2007 [Model 5, dry year].)

34 Sturgeon in the western Delta, Carquinez Strait, and Suisun Bay typically prey on
35 a mix of clams including *Corbula amurensis*, which is known to be an efficient
36 bioaccumulator of selenium (Stewart et al. 2010) and crustaceans. Presser and
37 Luoma (2013) assumed a sturgeon diet of 50 percent clams and 50 percent
38 amphipods and other crustaceans in their model. Based on this diet, the authors
39 reported a TTF of 9.2 (identified as TTF_{prey} in Table 1 of Presser and Luoma
40 [2013]). This TTF was used to calculate concentrations in sturgeon invertebrate

1 prey for the Sacramento River at Emmaton, San Joaquin River at Antioch, and
2 Montezuma Slough at Hunter Cut/Beldon's Landing locations under the No
3 Action Alternative, Second Basis of Comparison, and Alternatives 1 through 5.
4 A TTF of 1.3 from diet to fish (identified as $TTF_{predator}$) was reported for sturgeon
5 in Presser and Luoma (2013) and was used to calculate concentrations of
6 selenium in sturgeon for the three western Delta locations.
7 Modeling for sturgeon at the three western Delta locations did not require
8 refinement because it relied on recent data provided by Presser and Luoma
9 [2013]) and because data to refine the model were not available.

10 **6D.2 Modeling Simulations and Assumptions**

11 As described in Section 6D.1, selenium modeling was performed for evaluation of
12 the alternatives. This section describes the assumptions for the selenium model
13 simulations of the No Action Alternative, Second Basis of Comparison, and other
14 alternatives. A description of DSM2 model assumptions is in Appendix 5A.

15 The following model simulations were used as the basis of evaluating the impacts
16 of Alternatives 1 through 5 as compared to the No Action Alternative, and the No
17 Action Alternative and Alternatives 1 through 5 as compared to the Second Basis
18 of Comparison:

- 19 • No Action Alternative
- 20 • Second Basis of Comparison

21 The following selenium model simulations of other alternatives were performed:

- 22 • Alternative 1 – for selenium simulation purposes, considered the same as
23 Second Basis of Comparison
- 24 • Alternative 2 – for selenium simulation purposes, considered the same as No
25 Action Alternative
- 26 • Alternative 3
- 27 • Alternative 4 – for selenium simulation purposes, considered the same as
28 Second Basis of Comparison.
- 29 • Alternative 5

30 The general selenium modeling assumptions described in the following
31 subsection pertain to all the model runs.

32 **6D.2.1 Delta-wide Assumptions**

33 The calibrated Delta-wide selenium bioaccumulation models (Models 3, 4, and 5)
34 are considered representative of conditions in the Delta under current and likely
35 future conditions, because they incorporate realistic concentrations of waterborne
36 selenium and they predict selenium concentrations in predatory fish that
37 approximate measured concentrations in Largemouth Bass. The calibrated

1 models take into account the variable nature of selenium bioaccumulation in
2 relation to waterborne concentrations, which is reflected in the generally inverse
3 relationship between the K_d and waterborne selenium concentration.

4 Models are not available to quantitatively estimate the level of changes in
5 selenium bioaccumulation as related to residence time, but the effects of residence
6 time are incorporated in the bioaccumulation modeling for selenium that was
7 based on higher K_d values for drought years in comparison to wet, normal, or all
8 years. If increases in fish tissue or bird egg selenium were to occur, the increases
9 would likely be of concern only where fish tissues or bird eggs are already
10 elevated in selenium to near or above thresholds of concern. That is, where biota
11 concentrations are currently low and not approaching thresholds of concern
12 (which is the case throughout the Delta, except for sturgeon in the western Delta),
13 changes in residence time alone would not be expected to cause them to then
14 approach or exceed thresholds of concern. In consideration of this factor,
15 although the Delta as a whole is a Clean Water Act (CWA) Section 303(d)-listed
16 waterbody for selenium (SWRCB 2011), and although monitoring data of fish
17 tissue or bird eggs in the Delta are sparse, the most likely areas in which biota
18 tissue selenium concentrations would be high enough that additional
19 bioaccumulation due to increased residence time from restoration areas would be
20 a concern are the western Delta and Suisun Bay (discussed below for sturgeon),
21 and the south Delta in areas that receive San Joaquin River water.

22 The South Delta receives elevated selenium loads from the San Joaquin River. In
23 contrast to Suisun Bay and possibly the western Delta in the future, the south
24 Delta lacks the Overbite Clam (*Corbula [Potamocorbula] amurensis*), which is
25 considered a key driver of selenium bioaccumulation in Suisun Bay because of its
26 high bioaccumulation of selenium and its role in the benthic food web that
27 includes long-lived sturgeon. The south Delta does have *Corbicula fluminea*,
28 another bivalve that bioaccumulates selenium, but it is not as invasive as the
29 Overbite Clam and thus likely makes up a smaller fraction of sturgeon diet. Also,
30 nonpoint sources of selenium in the San Joaquin Valley that contribute selenium
31 to the Delta will be controlled through a Total Maximum Daily Load (TMDL)
32 developed by the Central Valley Regional Water Quality Control Board (Central
33 ValleyRWQCB) for the lower San Joaquin River, established limits for the
34 Grassland Bypass Project, and Basin Plan objectives (Central Valley RWQCB
35 2001, 2010; SWRCB 2010a, 2010b) that are expected to result in decreasing
36 discharges of selenium from the San Joaquin River to the Delta. Further, if
37 selenium levels in the San Joaquin River are not sufficiently reduced by these
38 efforts, it is expected that the SWRCB and Central Valley RWQCB would initiate
39 additional TMDLs to further control nonpoint sources of selenium.

40 **6D.2.2 Western Delta Sturgeon Assumptions**

41 Modeling for selenium bioaccumulation by sturgeon in the western Delta is
42 considered to be based on the most appropriate uptake factors available, which
43 were published recently by Presser and Luoma (2013) specifically for sturgeon in
44 northern San Francisco Bay estuary. The disparity between larger estimated
45 changes for sturgeon and smaller changes for other biota (that is, whole-body fish,

1 bird eggs, and fish fillets) is attributable largely to differences in modeling
2 approaches, as described previously. The model for most biota was calibrated to
3 encompass the varying concentration-dependent uptake from waterborne
4 selenium concentrations (expressed as the K_d , which is the ratio of selenium
5 concentrations in particulates [as the lowest level of the food chain] relative to the
6 waterborne concentration) that was exhibited in data for Largemouth Bass in
7 2000, 2005, and 2007 at various locations across the Delta. In contrast, the
8 modeling for sturgeon could not be similarly calibrated at the three western Delta
9 locations and used literature-derived uptake factors and TTFs for the estuary from
10 Presser and Luoma (2013). There was a significant negative log-log relationship
11 of K_d to waterborne selenium concentration that reflected the greater
12 bioaccumulation rates for bass at low waterborne selenium than at higher
13 concentrations. There was no difference in bass selenium concentrations in the
14 Sacramento River at Rio Vista compared to the San Joaquin River at Vernalis in
15 2000, 2005, and 2007 (Foe 2010a), despite a nearly 10-fold difference in
16 waterborne selenium concentrations. It is unknown whether this might also occur
17 in the sturgeon food web. Thus, there is more confidence in the site-specific
18 modeling based on the Delta-wide model that was calibrated for bass data than in
19 the estimates for sturgeon based on “fixed” K_d values for all years and for drought
20 years without regard to waterborne selenium concentration at the three locations
21 in different time periods.

22 The western Delta and Suisun Bay receive elevated selenium loads from North
23 San Francisco Bay (including San Pablo Bay, Carquinez Strait, and Suisun Bay)
24 and from the San Joaquin River. Point sources of selenium in North San
25 Francisco Bay (that is, refineries) that contribute selenium to Suisun Bay are
26 expected to be reduced through a TMDL under development by the San Francisco
27 Bay Regional Water Quality Control Board (San Francisco Bay RWQCB 2012)
28 that is expected to result in decreasing discharges of selenium. Nonpoint sources
29 of selenium in the San Joaquin Valley that contribute selenium to the San Joaquin
30 River, and thus the Delta and Suisun Bay, will be controlled through a TMDL
31 developed by the Central Valley RWQCB (2001) for the lower San Joaquin
32 River, established limits for the GBP, and Basin Plan objectives (Central Valley
33 RWQCB 2010; SWRCB 2010a, 2010b) that are expected to result in decreasing
34 discharges of selenium from the San Joaquin River to the Delta. If selenium
35 levels are not sufficiently reduced via these efforts, it is expected that the SWRCB
36 and the San Francisco Bay and Central Valley regional Water Quality Control
37 Boards would initiate additional actions to further control sources of selenium.

38 **6D.2.3 Model Application Methodology**

39 To evaluate differences in the impact assessment, modeled whole-body fish, bird
40 egg or fish fillet data were compared directly (for percent change) and to the
41 following threshold effect benchmarks:

- 42 • Whole-body fish for the Delta-wide model were compared to the Level of
43 Concern (4 milligrams per kilogram [mg/kg] dw; Beckon et al. 2008) and the
44 Toxicity Level (8.1 mg/kg dw; USEPA 2014) for fish tissue.

- 1 • Modeled bird egg selenium concentrations were compared to Level of
2 Concern (6 mg/kg dw) and Toxicity Level (10 mg/kg dw) values from Beckon
3 et al. (2008).
 - 4 • Fish fillet data were compared to the Advisory Tissue Level (2.5 µg/g ww) for
5 human consumption of fish (OEHHA 2008).
 - 6 • Whole-body selenium concentrations in sturgeon were compared to Low
7 Effect (5 mg/kg dw) and High Effect (8 mg/kg dw) guidelines from Presser
8 and Luoma (2013).
- 9 Results of comparisons to these benchmarks are expressed as Exceedance
10 Quotients (EQs) in some of the tables and figures. Annual average selenium
11 concentrations in water did not exceed the 5.0 µg/L(4-day average) or 20 µg/L
12 (1-hour average) criterion, so no EQs were calculated.

13 **6D.2.3.1 No Action Alternative and Second Basis of Comparison Models**

14 The purpose of the No Action Alternative and the Second Basis of Comparison
15 for comparison with the forecasts of the alternative models was to determine
16 whether the implementation of the proposed alternatives is likely to result in
17 substantial impacts to selenium, thereby affecting biological resources. The No
18 Action Alternative and the Second Basis of Comparison models were completed
19 for five Delta interior, three western Delta, and four major Delta diversion
20 locations. DSM2 post-processing output provided estimates of the waterborne
21 selenium concentration at each of those 12 locations (Table 6D.9). The Delta-
22 specific selenium bioaccumulation model that was calibrated using Largemouth
23 Bass data from the Delta was then used to estimate selenium concentrations in
24 whole-body fish and then in bird eggs and fish fillets. Selenium concentrations in
25 sturgeon inhabiting the western Delta (represented by three locations) were
26 estimated using recently published literature parameters. Modeled selenium
27 concentrations in whole-body fish (predatory fish throughout the Delta or
28 sturgeon in the western Delta), bird egg or fish fillet data were compared to the
29 threshold effect benchmarks listed previously. The modeled tissue selenium
30 concentrations themselves and the EQs (based on comparisons to thresholds) both
31 served as a basis for comparison of other alternatives to identify potential impacts.

32 **6D.2.3.2 Alternative Models**

33 For each of the alternative model simulations, the same procedure as described for
34 the No Action Alternative and the Second Basis of Comparison models was used,
35 with similar assumptions, to estimate waterborne selenium concentrations and
36 selenium concentrations in fish and bird eggs. Each alternative model simulation
37 for each type of biota (whole-body fish [either using the Delta-wide model for
38 bass or the western Delta sturgeon model], bird eggs, or fish fillets) was compared
39 to both the No Action Alternative and the Second Basis of Comparison to
40 determine potentially significant impacts.

1 **6D.3 Modeling Results**

2 The post-processing tool is Excel-based. The general pre-processing and input
3 files development are described in the modeling data assumptions sections above.
4 This section focuses on data analysis and results interpretation for the impact
5 assessment.

6 **6D.3.1 Post-processing and Results Analysis: Delta-wide Model**

7 Output data resulting from the model simulations for each alternative are
8 processed to provide a tabular depiction of potential impacts to fish and wildlife
9 (Tables 6D.13 through 6D.15). As discussed previously, outputs from the post-
10 processing model used in this analysis are annual average selenium fish tissue
11 concentrations for all year types and separately presented for the subset of drought
12 years.

13 The variation in concentrations between the No Action Alternative, Second Basis
14 of Comparison, and Alternatives 1 through 5 was less than 5 percent
15 (Tables 6D.13 through 6D.15). Annual average concentrations do not exceed the
16 selenium thresholds at all locations modeled in the Delta for all years and drought
17 years both as measured and as modeled. Results are shown in Tables 6D.9
18 through 6D.15 and Figures 6D.7 through 6D.10. Table 6D.9 presents the period-
19 average waterborne selenium concentrations by location and water year type that
20 were used to model fish tissue (whole-body and fillet) and bird egg concentrations
21 (Tables 6D.10 through 6D.12).

22 All estimated selenium concentrations in water and biota (whole-body fish, bird
23 eggs, and fish fillets) were below the benchmarks used for evaluation (presented
24 in Section 6D.2.4). The highest estimated selenium concentrations were for
25 Alternative 1 in the San Joaquin River at San Andreas Landing and Sacramento
26 River at Emmaton, and Alternative 3 in the North Bay Aqueduct at Barker Slough
27 in drought years (Tables 6D.10 through 6D.12). Changes in estimated selenium
28 concentrations for Alternatives 3 and 5 compared to the No Action Alternative
29 and Alternative 1 were less than 4 percent (Tables 6D.14 and 6D.15).

30 **6D.3.2 Post-processing and Results Analysis: Western Delta** 31 **Sturgeon Model**

32 Output data resulting from the sturgeon model simulations for each alternative at
33 the three western Delta locations were processed to provide a tabular depiction of
34 potential impacts to sturgeon. Table 6D.16 presents the period-average
35 waterborne selenium concentrations by location and water year type that were
36 used to model fish tissue concentrations (Table 6D.17). As discussed previously,
37 outputs from the post-processing model used in this analysis are annual average
38 selenium concentrations in whole-body sturgeon for all year types and separately
39 presented for the subset of drought years.

40 The expected variations in whole-body sturgeon selenium concentrations between
41 the No Action Alternative, the Second Basis of Comparison, and Alternatives 1
42 through 5 were less than 1 mg/kg dw (Table 6D.17). The highest estimated

1 selenium concentrations were for drought years at all three locations with little
2 difference among alternatives. Annual average sturgeon concentrations slightly
3 exceeded the low selenium thresholds for all locations and alternatives for
4 drought years, but not for all years. Results of comparisons to the thresholds are
5 shown in Table 6D.18 and Figure 6D.11. Estimated selenium concentrations did
6 not exceed high thresholds.

7 Changes in estimated selenium concentrations compared to the No Action
8 Alternative and Second Basis of Comparison are less than 5 percent for all years
9 and for drought years (Table 6D.19). The largest predicted changes were a small
10 decrease under Alternative 3 relative to the No Action Alternative for the San
11 Joaquin River at Antioch in all years and a small increase predicted for
12 Alternative 5 relative to Second Basis of Comparison at that location in all years.
13 Both of these predicted changes were less than 5 percent. However, as noted
14 previously, even the expected changes for the San Joaquin River at Antioch for
15 Alternatives 3 and 5 as compared to the No Action Alternative or the Second
16 Basis of Comparison were less than 1 mg/kg dw. It is not likely that such small
17 changes in whole-body selenium concentrations would be detectable under field
18 conditions.

19 **6D.3.3 Model Limitations and Applicability**

20 Although it is impossible to predict future hydrology, land use, and water use with
21 certainty, the selenium model and DSM2 were used to forecast impacts to fish and
22 wildlife that could result from implementation of the alternatives. The selenium
23 model for sturgeon has greater uncertainty than the selenium model for bass
24 because the sturgeon model was not as finely calibrated for varying K_d relative to
25 waterborne selenium concentrations throughout the Delta, as discussed in Section
26 6D.2.2. Mathematical models like DSM2 can only approximate processes of
27 physical systems. Models are inherently inexact because the mathematical
28 description of the physical system is imperfect and the understanding of
29 interrelated physical processes is incomplete. However, the selenium models are
30 powerful tools that, when used carefully, can provide useful insight into processes
31 of the physical system. Selenium concentrations for inflow sources to the Delta
32 (for example, agriculture in the Delta, Yolo Bypass, Eastside Tributaries) also
33 caused uncertainty in the modeling because of limited data. For the Sacramento
34 River and the San Joaquin River, approximately 90 data points (Chapter 6,
35 Table 6.58; Table 6D.1) were used to estimate the mean selenium concentrations
36 for these inflow sources, whereas the mean selenium concentrations for other
37 inflow sources to the Delta had many fewer (0 to 14) data points (concentrations
38 for the Eastside Tributaries were assumed).

39 **6D.4 References**

40 Beckon, W. 2014. How to estimate trophic position of fish from lag in
41 contaminant bioaccumulation. Poster abstracts, p. 16. 2014 Bay-Delta
42 Science Conference, October 28-30, Sacramento, California.

- 1 Beckon, W.N., M.C.S. Eacock, and A.G. Gordus. 2008. Biological Effects of the
2 Grassland Bypass Project. In San Francisco Estuary Institute for the
3 Grassland Bypass Project Oversight Committee, Grassland Bypass Project
4 2004-2005. San Francisco, CA. Chapter 7, pages 93–167.
- 5 Central Valley RWQCB (Central Valley Regional Water Quality Control Board).
6 2001. Total Maximum Daily Load for Selenium in the Lower San Joaquin
7 River. Staff Report. Sacramento, CA.
- 8 _____. 2010. Resolution No. R5-2010-0046 Amending the Water Quality Control
9 Plan for the Sacramento River and San Joaquin River Basins for the
10 Control of Selenium in the Lower San Joaquin River Basin. Adopted May
11 27. Available at:
12 [http://www.waterboards.ca.gov/centralvalley/board_decisions/adopted_or](http://www.waterboards.ca.gov/centralvalley/board_decisions/adopted_or_ders/resolutions/r5-2010-0046_res.pdf)
13 [ders/resolutions/r5-2010-0046_res.pdf](http://www.waterboards.ca.gov/centralvalley/board_decisions/adopted_or_ders/resolutions/r5-2010-0046_res.pdf).
- 14 DWR (Department of Water Resources) 2009. Water Data Library. Site accessed
15 on March 3, 2009. Available at:
16 <http://www.water.ca.gov/waterdatalibrary/>
- 17 Foe, C. 2010a. Selenium Concentrations in Largemouth Bass in the Sacramento-
18 San Joaquin Delta. Sacramento: Central Valley Regional Water Quality
19 Control Board. June.
- 20 _____. 2010b. Staff Environmental Scientist, Central Valley Regional Water
21 Quality Control Board, Sacramento, California. E-mail to H. Ohlendorf,
22 Technology Fellow, CH2M HILL, Sacramento, California. April 23.
- 23 Hothem, R.L., and H.M. Ohlendorf. 1989. Contaminants in foods of aquatic birds
24 at Kesterson Reservoir, California, 1985. Archives of Environmental
25 Contamination and Toxicology 18:773-786.
- 26 Lucas, L., and R. Stewart. 2007. Transport, Transformation, and Effects of
27 Selenium and Carbon in the Delta of the Sacramento-San Joaquin Rivers:
28 Implications for Ecosystem Restoration. Menlo Park, California: U.S.
29 Geological Survey.
- 30 OEHHA (Office of Environmental Health Hazard Assessment) 2008.
31 Development of Fish Contaminant Goals and Advisory Tissue Levels for
32 Common Contaminants in California Sport Fish: Chlordane, DDTs,
33 Dieldrin, Methylmercury, PCBs, Selenium, and Toxaphene. Oakland:
34 California Environmental Protection Agency.
- 35 Ohlendorf, H.M., and G.H. Heinz. 2011. Selenium in Birds. Environmental
36 Contaminants in Biota: Interpreting Tissue Concentrations, Second
37 Edition. 669-701. Eds. W.N. Beyer and J.P. Meador. Boca Raton: CRC
38 Press.
- 39 Ohlendorf, H.M., and R.L. Hothem. 1995. Agricultural Drainwater Effects on
40 Wildlife in Central California. Handbook of Ecotoxicology. 577-595. Eds.
41 D.J. Hoffman, B.A. Rattner, G.A. Burton, Jr., and J. Cairns, Jr. Boca
42 Raton: Lewis Publishers.

- 1 Presser, T.S., and S.N. Luoma. 2010a. A methodology for ecosystem-scale
2 modeling of selenium. *Integrated Environmental Assessment and*
3 *Management* 6:685-710.
- 4 _____. 2010b. *Ecosystem-scale Selenium Modeling in Support of Fish and*
5 *Wildlife Criteria Development for the San Francisco Bay-Delta Estuary,*
6 *California.* Administrative Report December. Reston, Virginia: U.S.
7 Geological Survey.
- 8 _____. 2013. *Ecosystem-scale Selenium Model for the San Francisco Bay-Delta*
9 *Regional Ecosystem Restoration Implementation Plan.* San Francisco
10 *Estuary and Watershed Science* 11(1):1-39. Available:
11 <http://www.escholarship.org/uc/item/2td0b99t> Accessed June 28, 2013.
- 12 Saiki, M.K., M.R. Jennings, and S.J. Hamilton. 1991. Preliminary Assessment of
13 the Effects of Selenium in Agricultural Drainage on Fish in the San
14 Joaquin Valley. *The Economics and Management of Water and Drainage*
15 *in Agriculture.* 369-385. Eds. A. Dinar and D. Zilberman. New York:
16 Springer.
- 17 Saiki, M.K., and T.P. Lowe. 1987. Selenium in aquatic organisms from
18 subsurface agricultural drainage water, San Joaquin Valley, California.
19 *Archives of Environmental Contamination and Toxicology* 16:657-670.
- 20 San Francisco Bay Regional Water Quality Control Board. 2008. Technical
21 Memorandum 2: North San Francisco Bay Selenium Data Summary and
22 Source Analysis. Prepared by Tetra Tech. Lafayette, California.
- 23 Santolo, G.M., J.T. Yamamoto, J.M. Piseni, and B.W. Wilson. 1999. Selenium
24 accumulation and effects on reproduction in captive American kestrels fed
25 selenomethionine. *Journal of Wildlife Management* 63:502-511.
- 26 Schuler, C.A., R.G. Anthony, and H.M. Ohlendorf. 1990. Selenium in wetlands
27 and waterfowl foods at Kesterson Reservoir, California, 1984. *Archives of*
28 *Environmental Contamination and Toxicology* 19:845-853.
- 29 SFEI (San Francisco Estuary Institute) 2014. Site accessed on September 30,
30 2014. URL = <http://cd3.sfei.org/>
- 31 Smith, G.J., G.H. Heinz, D.J. Hoffman, J.W. Spann, and A.J. Krynitsky. 1988.
32 Reproduction in black-crowned night-herons fed selenium. *Lake and*
33 *Reservoir Management* 4:175-180.
- 34 Stewart, R., M. Grosell, D. Buchwalter, N. Fisher, S. Luoma, T. Mathews, P. Orr,
35 and W.-X. Wang. 2010. Bioaccumulation and Trophic Transfer of
36 Selenium. *Ecological Assessment of Selenium in the Aquatic*
37 *Environment.* 93-139. Eds. P.M. Chapman, W.J. Adams, M.L. Brooks,
38 C.G. Delos, S.N. Luoma, W.A. Maher, H.M. Ohlendorf, T.S. Presser, and
39 D.P. Shaw. Boca Raton: CRC Press.

- 1 SWAMP (Central Valley Regional Water Quality Control Board Surface Water
2 Ambient Monitoring Program) 2009. Site accessed on April 4, 2009. URL
3 =
4 [www.swrcb.ca.gov/centralvalley/water_issues/water_quality_studies/surfa](http://www.swrcb.ca.gov/centralvalley/water_issues/water_quality_studies/surface_water_ambient_monitoring/index.shtml)
5 [ce_water_ambient_monitoring/index.shtml](http://www.swrcb.ca.gov/centralvalley/water_issues/water_quality_studies/surface_water_ambient_monitoring/index.shtml).
- 6 SWRCB (State Water Resources Control Board). 2010a. Resolution No. 2010-
7 0046 Approving Amendments to the Water Quality Control Plan for the
8 Sacramento River and San Joaquin River Basins (Basin Plan) to Address
9 Selenium Control in the San Joaquin River Basin. Adopted October 5.
10 Available:
11 [http://www.waterboards.ca.gov/board_decisions/adopted_orders/resoluti](http://www.waterboards.ca.gov/board_decisions/adopted_orders/resolutions/2010/rs2010_0046.pdf)
12 [ons/2010/rs2010_0046.pdf](http://www.waterboards.ca.gov/board_decisions/adopted_orders/resolutions/2010/rs2010_0046.pdf)>.
- 13 _____. 2010b. 10/05/10 Board Meeting–Item #5; Staff Change #1 (Circulated
14 09/30/10) for Resolution No. 2010-0046 Approving Amendments to the
15 Water Quality Control Plan for the Sacramento River and San Joaquin
16 River Basins (Basin Plan) to Address Selenium Control in the San Joaquin
17 River Basin. Adopted October 5. Available:
18 [http://www.waterboards.ca.gov/board_info/agendas/2010/oct/100510_5ch](http://www.waterboards.ca.gov/board_info/agendas/2010/oct/100510_5changesheet1.pdf)
19 [angesheet1.pdf](http://www.waterboards.ca.gov/board_info/agendas/2010/oct/100510_5changesheet1.pdf).
- 20 _____. 2011. 2010 CWA Section 303(d) List of Water Quality Limited Segments.
21 Approved by U.S. EPA on December 23, 2011. Available:
22 [http://www.swrcb.ca.gov/centralvalley/water_issues/tmdl/impaired_waters](http://www.swrcb.ca.gov/centralvalley/water_issues/tmdl/impaired_waters_list/index.shtml#currentrpt)
23 [list/index.shtml#currentrpt](http://www.swrcb.ca.gov/centralvalley/water_issues/tmdl/impaired_waters_list/index.shtml#currentrpt).
- 24 USEPA (U. S. Environmental Protection Agency). 2014. External Peer Review
25 Draft: Aquatic Life Ambient Water Quality Criterion for Selenium –
26 Freshwater. U.S. Environmental Protection Agency, Washington, D.C.
- 27 USGS (U.S. Geological Survey). 2014. USGS Water-Quality Daily Data for
28 California. Site accessed on September 26, 2014, URL =
29 [http://nwis.waterdata.usgs.gov/nwis/qwdata?search_criteria=search_statio](http://nwis.waterdata.usgs.gov/nwis/qwdata?search_criteria=search_station_nm&submitted_form=introduction)
30 [n_nm&submitted_form=introduction](http://nwis.waterdata.usgs.gov/nwis/qwdata?search_criteria=search_station_nm&submitted_form=introduction).
- 31 Wiemeyer, S.J., and D.J. Hoffman. 1996. Reproduction in eastern screech-owls
32 fed selenium. *Journal of Wildlife Management* 60:332-341.
- 33 Young, T.F., K. Finley, W.J. Adams, J. Besser, W.D. Hopkins, D. Jolley, E.
34 McNaughton, T.S. Presser, D.P. Shaw, and J. Unrine. 2010. What You
35 Need to Know about Selenium. *Ecological Assessment of Selenium in the*
36 *Aquatic Environment*. 7-45. Eds. P.M. Chapman, W.J. Adams, M.L.
37 Brooks, C.G. Delos, S.N. Luoma, W.A. Maher, H.M. Ohlendorf, T.S.
38 Presser, and D.P. Shaw. Boca Raton: CRC Press.

1 Table 6D.2 Calculation of Quarterly Average Selenium Concentrations for DSM2 Output Locations Based on Percentage of Flow at Each Location from Different Sources: Year 2000

DSM2 Output Water Location	Inflow Source → Inflow Location → Selenium (µg/L) →	First Quarter Inflow Percentage						Second Quarter Inflow Percentage						Third Quarter Inflow Percentage						Fourth Quarter Inflow Percentage						Estimated Waterborne Selenium Concentrations (µg/L)					
		Delta Ag.	East Delta Tributaries	Sac. R.	San Joaq. R.	Martinez/Suisun Bay	Yolo Bypass	Delta Ag.	East Delta Tributaries	Sac. R.	San Joaq. R.	Martinez/Suisun Bay	Yolo Bypass	Delta Ag.	East Delta Tributaries	Sac. R.	San Joaq. R.	Martinez/Suisun Bay	Yolo Bypass	Delta Ag.	East Delta Tributaries	Sac. R.	San Joaq. R.	Martinez/Suisun Bay	Yolo Bypass	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Annual	
		Mildred Island, Center	Mokelumne Calaveras Cosumnes Rivers	Freeport	Vernalis	San Joaq. R. near Mallard Island	Sac. R. below Knights Landing	Mildred Island, Center	Mokelumne Calaveras Cosumnes Rivers	Freeport	Vernalis	San Joaq. R. near Mallard Island	Sac. R. below Knights Landing	Mildred Island, Center	Mokelumne Calaveras Cosumnes Rivers	Freeport	Vernalis	San Joaq. R. near Mallard Island	Sac. R. below Knights Landing	Mildred Island, Center	Mokelumne Calaveras Cosumnes Rivers	Freeport	Vernalis	San Joaq. R. near Mallard Island	Sac. R. below Knights Landing						
Big Break	BIGBRK_MID	2.94	6.88	53.15	6.59	0.18	5.70	2.95	6.37	73.59	13.55	0.27	3.12	3.13	0.45	85.63	0.44	4.15	6.12	2.13	0.20	84.85	0.02	8.76	3.96	0.13	0.20	0.10	0.10	0.13	
Cache Slough	CACHS_LEN	1.46	0	53.38	0	0	31.91	1.24	1.5E-05	85.07	2.5E-05	0	13.25	1.66	4.7E-07	85.95	4.3E-07	5.9E-07	12.23	1.32	2.8E-06	89.83	1.1E-07	2.3E-05	8.67	0.12	0.11	0.11	0.10	0.11	
Cache Slough	CACHSR_MID	2.88	0	54.86	0	0	20.48	3.36	9.8E-07	79.75	1.9E-06	0	16.25	1.90	9.3E-08	84.53	1.8E-07	9.2E-12	13.38	1.81	1.0E-07	89.45	6.2E-10	3.0E-06	8.54	0.10	0.11	0.11	0.10	0.11	
Ryer																															
Cosumnes R.	COSR_LEN	8.1E-06	98.82	0	0	0	0	100.00	0	0	0	0	0	100.00	0	0	0	0	0	100.00	0	0	0	0	0	0.10	0.10	0.10	0.10	0.10	
Franks Tract	FRANKST_MID	5.06	11.56	43.94	15.79	0.02	0.32	4.17	9.42	61.16	23.89	0.01	1.22	4.04	0.57	90.34	0.41	0.80	3.78	2.76	0.62	91.38	0.12	2.42	2.64	0.19	0.27	0.10	0.10	0.16	
Little Holland Tract	LHOLND_LO	72.35	0	5.06	0	0	6.50	23.38	8.2E-07	63.10	1.6E-06	0	13.03	18.48	2.2E-07	68.67	4.2E-07	7.2E-13	12.68	19.63	2.6E-09	72.79	0	0	7.42	0.10	0.11	0.11	0.10	0.11	
Middle R Bullfrog	MIDRBULFRG_LEN	10.54	13.07	18.37	32.20	1.9E-03	3.2E-03	5.49	9.19	14.96	70.17	4.2E-04	0.10	7.81	6.43	69.63	14.94	0.12	1.02	4.86	6.31	59.79	27.84	1	0.68	0.31	0.61	0.20	0.30	0.36	
Mildred Island	MILDRISL_MID	7.47	14.31	22.79	30.23	2.4E-03	1.8E-03	4.77	10.05	18.48	66.48	6.7E-04	0.13	6.57	4.57	83.28	4.14	0.15	1.25	4.50	6.63	71.28	16.13	0.61	0.82	0.29	0.58	0.12	0.21	0.30	
Mok. R. below Cosum.	MOKBCOS_LEN	2.07	96.19	0	0	0	0	1.65	98.35	0	0	0	0	7.23	92.77	4.7E-09	0	0	0	2.47	97.53	0	0	0	0	0.10	0.10	0.10	0.10	0.10	
Mok. R. downstream Cosum.	MOKDCOS_MID	2.07	96.43	0	0	0	0	1.68	98.32	0	0	0	0	7.08	92.92	0	0	0	0	2.34	97.66	0	0	0	0	0.10	0.10	0.10	0.10	0.10	
Old R near Paradise Cut	OLDRNPARADSEC_MID	6.24	0	0	87.26	0	0	14.40	1.67	5.21	78.66	1.2E-05	0.04	10.56	3.9E-05	1.3E-04	89.44	8.8E-28	3.0E-07	2.50	1.1E-04	3.5E-04	97.50	2.8E-20	1.7E-07	0.73	0.68	0.75	0.81	0.74	
Paradise Cut	PARADSECUT_LEN	4.69	0	0	91.37	0	0	2.62	0.06	0.15	97.16	1.5E-07	1.1E-03	3.43	0	0	96.57	0	0	0.96	0	0	99.04	0	0	0.76	0.81	0.81	0.82	0.80	
Port of Stockton	PORTOSTOCK_LO	1.67	0	0	18.85	0	0	2.22	0	0	60.73	0	0	3.09	0	0	81.32	0	0	2.70	0	0	89.89	0	0	0.16	0.51	0.68	0.75	0.52	
Sac. R. at Isleton	SACRISLTON_LO	0.33	0	95.77	0	0	0	0.31	0.00	99.60	0	0	5.5E-05	0.44	0	99.55	0	0	1.3E-05	0.28	0	99.72	0	0	1.1E-03	0.09	0.09	0.09	0.09	0.09	
Sac River RM 44	SACR44_LO	0.14	0	97.93	0	0	0	0.11	0	99.81	0	0	0	0.13	0	99.86	0	0	0	0.05	0	99.94	0	0	0	0.09	0.09	0.09	0.09	0.09	
Sandmound Sl.	SANDMND_MID	6.36	10.51	43.82	12.90	0.03	0.57	5.22	8.81	63.78	20.40	0.03	1.63	5.24	0.61	87.78	0.49	1.22	4.59	3.31	0.43	89.58	0.06	3.44	3.11	0.17	0.25	0.10	0.10	0.15	
Sherman Island	SHERMNILND_LO	1.64	3.45	52.71	3.93	0.60	12.10	2.48	4.95	76.80	10.96	0.96	3.67	2.60	0.40	81.69	0.46	8.21	6.56	1.77	0.11	77.64	0.01	16.46	3.94	0.11	0.18	0.10	0.10	0.12	
SJR Bowman	SJRBOWMN_MID	1.40	0	0	94.03	0	0	1.52	0	0	98.48	0	0	3.00	0	97.00	0	0	0.33	0	0	99.67	0	0	0	0.78	0.82	0.81	0.83	0.81	
SJR N Hwy4	SJRNHWY4_MID	3.49	0	0	89.96	0	0	1.87	0	0	98.13	0	0	3.91	0	96.09	0	0	0.72	0	0	99.28	0	0	0	0.75	0.82	0.80	0.82	0.80	
SJR Naval st	SJRNAVLSL_LO	8.89	12.70	0.00	65.44	0	0	2.69	6.26	0	90.94	0	0	5.98	10.89	0	83.00	0	0	2.02	3.10	0.00	94.84	0	0	0.57	0.76	0.71	0.79	0.71	
SJR Potato Slough	SJRPOTSL_MID	3.15	12.62	55.38	12.40	0.01	0.06	3.05	10.32	65.93	19.73	0.01	0.86	2.63	0.35	93.54	0.20	0.45	2.79	2.06	0.80	93.46	0.06	1.47	2.11	0.17	0.24	0.10	0.09	0.15	
SJR Turner	SJRTURNR_MID	8.81	9.28	2.55	56.31	5.3E-05	1.0E-05	3.33	5.77	0.41	90.39	6.3E-06	2.4E-03	8.69	13.75	17.87	59.41	0.01	0.16	3.23	4.83	7.34	84.49	0.03	0.05	0.49	0.76	0.53	0.72	0.62	
SJR/Pt.	ASRANTFSH_MID	1.92	4.35	55.13	4.50	0.44	10.23	2.45	4.72	77.70	10.28	0.76	3.91	2.64	0.35	83.38	0.38	6.66	6.52	1.82	0.12	80.54	0.01	13.33	4.11	0.12	0.17	0.10	0.10	0.12	
Antioch/fish pier																															
Suisun Bay	SUISNB_LEN	0.81	1.22	45.93	1.24	16.49	15.94	0.92	1.66	49.51	3.61	41.10	2.95	0.80	0.23	27.56	0.40	68.55	2.42	0.60	0.03	28.62	0.01	69.16	1.54	0.11	0.13	0.10	0.10	0.11	
Sycamore Slough	SYCAMOR_MID	6.50	50.69	15.18	0	0	0	5.89	76.86	16.89	2.8E-07	0	0	5.04	14.29	80.66	1.2E-31	0	0	4.23	31.10	64.66	0	0	0	0.07	0.10	0.09	0.09	0.09	
White Slough	WHITESL_LO	22.32	11.88	17.97	25.51	1.7E-08	6.0E-11	16.54	12.10	16.87	54.46	3.7E-09	6.1E-05	9.89	7.76	82.34	3.8E-03	3.0E-05	5.3E-04	11.19	12.92	75.64	0.24	4.2E-04	6.4E-04	0.26	0.50	0.09	0.10	0.24	
White Slough DS Disappointment Sl.	WHTSLDISPONT_LEN	14.83	22.63	29.02	22.45	5.4E-08	0	12.45	13.97	21.21	52.32	2.2E-09	2.3E-04	8.74	7.78	83.47	2.4E-03	4.0E-05	5.6E-04	5.28	14.84	79.82	0.05	5.0E-04	7.3E-04	0.25	0.48	0.09	0.09	0.23	

2

1 **Table 6D.3 Calculation of Quarterly Average Selenium Concentrations for DSM2 Output Locations Based on Percentage of Flow at Each Location from Different Sources: Year 2005**

DSM2 Output Water Location	Inflow Source → Inflow Location → Selenium (µg/L) →	First Quarter Inflow Percentage						Second Quarter Inflow Percentage						Third Quarter Inflow Percentage						Fourth Quarter Inflow Percentage						Estimated Waterborne Selenium Concentrations (µg/L)				
		Delta Ag.	East Delta Tributaries	Sac. R.	San Joaq. R.	Martinez/Suisun Bay	Yolo Bypass	Delta Ag.	East Delta Tributaries	Sac. R.	San Joaq. R.	Martinez/Suisun Bay	Yolo Bypass	Delta Ag.	East Delta Tributaries	Sac. R.	San Joaq. R.	Martinez/Suisun Bay	Yolo Bypass	Delta Ag.	East Delta Tributaries	Sac. R.	San Joaq. R.	Martinez/Suisun Bay	Yolo Bypass	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Annual
		Mildred Island, Center	Mokelumne Calaveras Cosumnes Rivers	Freeport	Vernalis	San Joaq. R. near Mallard Island	Sac. R. below Knights Landing	Mildred Island, Center	Mokelumne Calaveras Cosumnes Rivers	Freeport	Vernalis	San Joaq. R. near Mallard Island	Sac. R. below Knights Landing	Mildred Island, Center	Mokelumne Calaveras Cosumnes Rivers	Freeport	Vernalis	San Joaq. R. near Mallard Island	Sac. R. below Knights Landing	Mildred Island, Center	Mokelumne Calaveras Cosumnes Rivers	Freeport	Vernalis	San Joaq. R. near Mallard Island	Sac. R. below Knights Landing					
Big Break	BIGBRK_MID	5.87	7.57	83.73	2.41	0.24	0.18	2.90	17.21	52.77	26.69	1.6E-03	0.43	3.31	2.21	88.77	1.70	3.98	0.03	2.39	0.24	90.17	0.01	6.48	0.70	0.11	0.30	0.10	0.09	0.15
Cache Slough	CACHS_LEN	4.89	2.2E-07	93.64	8.E-07	3.8E-07	1.47	1.48	7.1E-07	94.13	8.0E-07	1.1E-08	4.38	1.94	1.7E-05	98.02	1.0E-05	1.6E-06	0.05	2.30	1.2E-05	92.72	4.6E-07	0.00	4.98	0.09	0.10	0.09	0.10	0.09
Cache Slough	CACHSR_MID	8.13	3.0E-07	91.14	1.2E-06	1.3E-06	0.73	3.74	2.5E-08	91.89	1.0E-07	2.9E-08	4.38	2.15	5.6E-07	97.77	2.6E-07	4.5E-09	0.08	2.66	8.8E-07	96.37	1.9E-08	7.6E-06	0.97	0.09	0.10	0.09	0.09	0.09
Ryer																														
Cosumnes R.	COSR_LEN	0	100.00	0	0	0	0	0.00	100.00	0.00	0	0	0	0	100	0	0	0	0	1.2E-04	100.00	0	0	0	0	0.10	0.10	0.10	0.10	0.10
Franks Tract	FRANKST_MID	8.65	11.65	72.50	7.E+00	0.19	0.05	4.63	16.63	26.97	51.74	1.1E-04	0.03	4.27	3.20	89.93	1.81	0.77	0.02	3.17	0.81	94.16	0.06	1.74	0.05	0.15	0.49	0.11	0.09	0.21
Little Holland Tract	LHOLND_LO	97.11	3.2E-09	2.88	9.E-09	3.9E-09	0.01	44.12	6.5E-09	53.25	2E-08	1.2E-08	2.63	18.61	5.6E-07	81.24	0.00	0.00	0.16	46.22	6.1E-08	53.77	2.8E-08	2.6E-09	0.01	0.11	0.10	0.09	0.10	0.10
Middle R Bullfrog	MIDRBULFRG_LEN	13.67	9.76	28.26	48.24	0.08	0.01	5.55	5.64	2.70	86.11	7.1E-05	8.4E-04	7.43	12.50	53.07	26.88	0.12	3.1E-03	5.54	8.75	65.65	19.67	0.39	1.1E-03	0.46	0.75	0.30	0.24	0.44
Mildred Island	MILDDRISL_MID	12.36	11.39	32.28	43.87	8.4E-02	0.01	4.81	6.98	2.78	85.43	3.6E-05	6.7E-04	6.73	12.68	65.46	14.98	0.15	3.9E-03	4.81	7.16	77.85	9.71	0.47	1.8E-03	0.43	0.74	0.21	0.17	0.38
Mok. R. below Cosum.	MOKBCOS_LEN	2.18	97.82	0	0.00	0	0	0.53	99.47	0	0	0	0	3.05	96.95	0	0	0	0	3.00	97.00	0	0	0	0	0.10	0.10	0.10	0.10	0.10
Mok. R. downstream Cosum.	MOKDCOS_MID	2.22	97.78	0	0.00	0	0	0.53	99.47	0	0	0	0	3.05	96.95	0	0	0	0	2.93	97.07	0	0	0	0	0.10	0.10	0.10	0.10	0.10
Old R near Paradise Cut	OLDRNPARADSEC_MID	8.95	4.7E-05	1.5E-03	91.05	1.4E-05	1.4E-06	1.43	1.7E-07	1.6E-05	98.57	1.7E-08	3.5E-10	6.64	0	5.E-09	93.36	0	0	14.49	0.24	3.16	82.09	0.02	8.1E-05	0.78	0.84	0.80	0.72	0.79
Paradise Cut	PARADSECUT_LEN	10.28	1.6E-07	6.8E-07	89.72	1.6E-11	1.7E-08	0.82	0	0	99.18	0	0	2.39	0	0	97.61	0	0	1.08	0	0	98.92	0	0	0.77	0.84	0.83	0.84	0.82
Port of Stockton	PORTOSTOCK_LO	4.70	0	0	95.30	0	0	2.83	0	0	97.16	0	0	2.20	0	0	97.80	0	0	2.20	0	0	97.79	0	0	0.82	0.83	0.83	0.83	0.83
Sac. R. at Isleton	SACRISLTON_LO	0.55	0	99.45	0.00	0	0	0.18	0	99.82	0.00	0	0	0.45	0	99.55	0.00	0	0	0.41	0	99.59	0	0	8.2E-08	0.09	0.09	0.09	0.09	0.09
Sac River RM 44	SACR44_LO	0.21	0	99.79	0.00	0	0	0.07	0	99.93	0.00	0	0	0.14	0	99.86	0.00	0	0	0.17	0	99.83	0	0	0	0.09	0.09	0.09	0.09	0.09
Sandmound Sl.	SANDMND_MID	10.51	10.17	74.35	4.65	0.25	0.07	5.35	18.03	32.15	44.41	1.5E-04	0.06	5.61	3.13	87.97	2.10	1.17	0.02	3.93	0.55	92.97	0.03	2.45	0.07	0.13	0.43	0.11	0.09	0.19
Sherman Island	SHERMNILND_LO	4.89	5.04	87.74	1.52	0.56	0.23	2.43	14.17	61.17	21.31	0.03	0.89	2.76	1.84	86.03	1.72	7.62	0.04	1.95	0.11	84.69	0.01	11.76	1.48	0.10	0.26	0.10	0.09	0.14
SJR Bowman	SJRBOWMN_MID	1.10	0	0.00	98.90	0	0	0.45	0	99.55	0	0	0	2.06	0	97.94	0	0	0.80	0	99.20	0	0	0	0	0.84	0.85	0.83	0.84	0.84
SJR N Hwy4	SJRNHWY4_MID	1.89	0	0.00	98.11	0	0	0.59	0	99.41	0	0	0	2.64	0	97.36	0	0	1.94	0.00	98.06	0	0	0	0	0.84	0.85	0.83	0.84	0.84
SJR Naval st	SJRNAVLSL_LO	4.70	5.45	0.00	89.85	0	0	1.06	5.10	0	93.84	0	0	4.11	9.43	0	86.46	0	0	4.97	12.46	0	82.57	0	0	0.77	0.80	0.75	0.72	0.76
SJR Potato Slough	SJRPOTSL_MID	6.24	16.03	71.18	6.45	0.07	0.03	2.65	23.15	38.61	35.59	1.1E-05	0.01	2.75	2.58	93.40	0.83	0.42	0.01	2.16	1.30	95.35	0.02	1.04	0.13	0.14	0.36	0.10	0.09	0.17
SJR Turner	SJRTURNR_MID	6.75	4.55	1.37	87.31	0.01	0	1.49	3.20	0.00	95.31	0	0	6.05	11.77	4.90	77.27	0.01	8.4E-05	5.55	16.96	10.99	66.44	0.06	7.4E-05	0.76	0.81	0.68	0.60	0.71
SJR/Pt.	ASRANTFSH_MID	4.87	5.29	87.53	1.67	0.37	0.27	2.37	13.56	62.61	20.61	0.02	0.84	2.82	1.68	87.76	1.46	6.24	0.03	2.05	0.14	86.70	0.01	9.68	1.42	0.10	0.25	0.10	0.09	0.14
Antioch/fish pier																														
Suisun Bay	SUISNB_LEN	2.63	1.36	66.87	0.33	28.58	0.23	1.35	6.21	59.91	8.33	22.38	1.82	0.83	0.82	31.47	1.16	65.65	0.07	0.68	0.05	32.01	0.03	66.56	0.68	0.10	0.16	0.11	0.10	0.11
Sycamore Slough	SYCAMOR_MID	14.41	68.02	17.57	8.8E-17	0	3.5E-29	3.66	95.02	1.31	1.E-18	0	3.9E-33	4.79	40.41	54.81	2.9E-20	0	1.1E-32	5.24	32.04	62.72	2.6E-18	7.7E-14	1.0E-30	0.10	0.10	0.09	0.09	0.10
White Slough	WHITESL_LO	47.62	12.39	33.06	6.93	8.2E-04	2.7E-06	15.95	8.06	2.95	73.04	1.4E-05	1.5E-07	10.03	26.20	63.17	0.61	3.0E-05	8.1E-08	9.32	12.33	78.34	0.01	4.6E-04	4.6E-08	0.15	0.65	0.10	0.09	0.25
White Slough DS Disappointment Sl.	WHTSLDISPONT_LEN	20.77	29.09	44.03	6.11	2.4E-04	3.6E-06	14.40	8.89	3.00	73.72	7.9E-06	0	9.10	26.19	64.27	0.45	3.1E-05	0	6.26	14.39	79.35	1.9E-03	6.8E-04	0	0.14	0.65	0.10	0.09	0.25

2

1 **Table 6D.4 Calculation of Quarterly Average Selenium Concentrations for DSM2 Output Locations Based on Percentage of Flow at Each Location from Different Sources: Year 2007**

DSM2 Output Water Location	Inflow Source → Inflow Location → Selenium (µg/L) → Location ID	First Quarter Inflow Percentage						Second Quarter Inflow Percentage						Third Quarter Inflow Percentage						Fourth Quarter Inflow Percentage						Estimated Waterborne Selenium Concentrations (µg/L)				
		Delta Ag.	East Delta Tributaries	Sac. R.	San Joaq. R.	Martinez/Suisun Bay	Yolo Bypass	Delta Ag.	East Delta Tributaries	Sac. R.	San Joaq. R.	Martinez/Suisun Bay	Yolo Bypass	Delta Ag.	East Delta Tributaries	Sac. R.	San Joaq. R.	Martinez/Suisun Bay	Yolo Bypass	Delta Ag.	East Delta Tributaries	Sac. R.	San Joaq. R.	Martinez/Suisun Bay	Yolo Bypass	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Annual
		Mildred Island, Center	Mokelumne Calaveras Cosumnes Rivers	Freeport	Vernalis	San Joaq. R. near Mallard Island	Sac. R. below Knights Landing	Mildred Island, Center	Mokelumne Calaveras Cosumnes Rivers	Freeport	Vernalis	San Joaq. R. near Mallard Island	Sac. R. below Knights Landing	Mildred Island, Center	Mokelumne Calaveras Cosumnes Rivers	Freeport	Vernalis	San Joaq. R. near Mallard Island	Sac. R. below Knights Landing	Mildred Island, Center	Mokelumne Calaveras Cosumnes Rivers	Freeport	Vernalis	San Joaq. R. near Mallard Island	Sac. R. below Knights Landing					
Big Break	BIGBRK_LEN	2.66	1.75	93.01	0.07	2.30	0.21	4.40	3.10	84.13	4.24	1.24	2.89	3.58	0.32	81.60	0.79	9.45	4.27	2.60	0.11	84.06	0.04	8.53	4.65	0.09	0.12	0.10	0.10	0.10
Cache Slough	CACHS_LEN	1.86	1.4E-05	97.14	2.2E-07	2.8E-05	1.01	1.99	5.1E-04	88.84	8.8E-04	1.6E-05	9.17	1.92	9.1E-06	89.20	1.9E-05	1.6E-06	8.88	1.64	1.9E-05	91.73	8.5E-06	5.1E-04	6.62	0.09	0.10	0.10	0.10	0.10
Cache Slough	CACHSR_LEN	2.85	1.8E-06	96.46	4.7E-08	1.5E-05	0.68	2.66	1.2E-04	88.76	1.8E-04	1.4E-06	8.58	2.16	1.5E-05	88.35	3.1E-05	3.1E-07	9.49	1.96	4.5E-06	90.83	2.8E-06	1.9E-04	7.21	0.09	0.10	0.10	0.10	0.10
Ryer																														
Cosumnes R.	COSR_LEN	0.00	100.00	0	0	0	0.00	0.01	99.99	0	0	0	0	0.09	99.91	0	0	0	0	0	100.00	0	0	0	0.00	0.10	0.10	0.10	0.10	0.10
Franks Tract	FRANKST_LEN	3.85	4.08	90.69	0.32	0.94	0.11	6.16	5.35	77.86	9.10	0.16	1.38	4.86	0.34	88.03	0.84	2.96	2.98	3.19	0.32	91.15	0.17	2.23	2.95	0.09	0.14	0.10	0.10	0.11
Little Holland Tract	LHOLND_LEN	29.80	0.00	69.38	1.2E-07	5.3E-05	0.81	22.80	8.0E-05	71.18	1.1E-04	5.2E-06	6.02	18.52	2.4E-05	73.18	0.00	4.9E-07	8.30	21.64	5.2E-07	71.72	1.4E-06	4.9E-05	6.64	0.10	0.10	0.11	0.10	0.10
Middle R Bullfrog	MIDRBULFRG_LEN	8.32	10.69	59.08	21.39	0.48	0.04	9.69	10.67	38.75	40.64	0.03	0.22	8.41	3.92	81.16	4.51	0.87	1.14	5.81	4.90	72.42	15.36	0.57	0.94	0.20	0.29	0.12	0.17	0.19
Mildred Island	MILDDRISL_LEN	7.42	11.13	68.24	12.63	0.54	0.04	8.53	10.39	42.57	38.23	0.03	0.25	6.49	1.12	88.25	1.83	1.00	1.30	4.91	4.55	80.81	7.99	0.66	1.08	0.15	0.28	0.10	0.13	0.17
Mok. R. below Cosum.	MOKBCOS_LEN	1.46	98.54	0	0	0	0	6.32	93.68	6.5E-04	0	0	0	15.09	84.81	0.10	6.2E-35	0	0	2.30	97.70	0	0	0	0	0.10	0.10	0.10	0.10	0.10
Mok. R. downstream Cosum.	MOKDCOS_LEN	1.46	98.54	0	0	0	0	6.42	93.58	0	0	0	0	15.19	84.81	3.2E-04	0	0	0	2.27	97.73	0	0	0	0	0.10	0.10	0.10	0.10	0.10
Old R near Paradise Cut	OLDRNPARADSEC_LEN	3.95	5E-12	3E-06	96.05	1.7E-16	2.5E-17	15.73	1.81	12.66	69.68	0.02	0.10	10.18	1.9E-05	1.6E-04	89.82	6.9E-08	6.5E-07	2.31	9.2E-04	0.01	97.68	0	9.7E-05	0.56	0.43	0.53	0.57	0.52
Paradise Cut	PARADSECUT_LEN	1.91	0	0	98.09	0	0	4.98	0.11	0.61	94.29	6.7E-04	3.7E-03	7.14	0	0	92.86	0	0	1.24	4.1E-03	0.05	98.71	4.1E-04	4.5E-04	0.57	0.55	0.55	0.57	0.56
Port of Stockton	PORTOSTOCK_LEN	1.48	0	0	98.52	0	0	2.29	0	0	97.71	0	0	6.32	0.04	0	93.64	0	0	7.16	0.05	0	92.78	0	0	0.57	0.57	0.55	0.55	0.56
Sac. R. at Isleton	SACRISLTON_LEN	0.45	0	99.55	0	0	2.1E-06	0.63	8.8E-05	99.36	5.7E-08	0	0.01	0.49	0	99.51	0	0	2.9E-04	0.39	1.0E-08	99.61	0	6.7E-07	0.01	0.09	0.09	0.09	0.09	0.09
Sac River RM 44	SACR44_LEN	0.20	0	99.80	0	0	0	0.30	0	99.70	0	0	0	0.15	0	99.85	0	0	0	0.11	0	99.89	0	0	0	0.09	0.09	0.09	0.09	0.09
Sandmound Sl.	SANDMND_LEN	4.47	3.23	90.83	0.17	1.17	0.13	7.20	4.64	79.23	6.98	0.23	1.71	6.15	0.39	84.96	0.98	4.06	3.46	3.79	0.22	89.26	0.10	3.11	3.51	0.09	0.13	0.10	0.10	0.10
Sherman Island	SHERMNILND_LEN	2.14	0.95	92.16	0.04	4.49	0.23	3.69	2.31	83.94	2.94	4.01	3.11	2.99	0.32	77.36	0.77	14.22	4.34	2.22	0.06	75.89	0.03	17.11	4.68	0.09	0.11	0.10	0.10	0.10
SJR Bowman	SJRBOWMN_LEN	0.88	0	0	99.12	0	0	3.52	0	0	96.48	0	0	8.49	2.5E-04	0	91.51	0	0	0.91	0	99.09	0	0	0	0.58	0.56	0.54	0.58	0.56
SJR N Hwy4	SJRNHWY4_LEN	1.82	2.8E-08	0	98.18	0	0	4.35	1.4E-07	0	95.65	0	0	12.54	0.08	4.0E-26	87.39	0	0	1.89	1.3E-04	0	98.11	0	0	0.57	0.56	0.52	0.57	0.56
SJR Naval st	SJRNAVLS_LEN	4.83	6.83	0	88.35	0	0	5.86	11.12	1.3E-06	83.02	0	0	12.06	40.15	3.4E-03	47.78	6.2E-07	6.3E-06	4.73	6.37	2.5E-04	88.90	5.4E-09	7.0E-09	0.52	0.50	0.33	0.53	0.47
SJR Potato Slough	SJRPOTSL_LEN	2.91	5.22	91.00	0.15	0.61	0.10	4.89	5.67	79.70	8.49	0.10	1.16	3.16	0.19	91.86	0.46	1.88	2.44	2.37	0.33	93.43	0.10	1.44	2.33	0.09	0.13	0.10	0.09	0.10
SJR Turner	SJRTURNR_LEN	7.22	10.11	10.82	71.76	0.08	0.01	7.49	11.95	7.23	73.31	2.9E-03	0.02	11.09	11.29	65.50	11.02	0.46	0.63	6.16	6.57	36.18	50.55	0.19	0.35	0.44	0.45	0.15	0.34	0.35
SJR/Pt.	ASRANTFSH_LEN	2.17	1.01	92.90	0.04	3.62	0.26	3.74	2.30	84.37	3.04	3.24	3.31	3.00	0.27	79.62	0.65	12.05	3.40	2.27	0.07	78.73	0.03	14.08	4.82	0.09	0.11	0.10	0.10	0.10
Antioch/fish pier																														
Suisun Bay	SUISNB_LEN	0.87	0.23	46.77	0.01	51.97	0.14	0.94	0.51	31.58	0.43	65.55	0.98	0.84	0.16	21.30	0.36	76.08	1.25	0.59	0.02	21.39	0.01	76.63	1.36	0.10	0.10	0.10	0.10	0.10
Sycamore Slough	SYCAMOR_LEN	10.20	72.58	17.22	5.1E-10	9.7E-14	4.3E-29	13.62	50.90	35.47	0.01	4.0E-09	1.1E-07	5.33	3.90	90.77	1.9E-16	3.8E-25	1.1E-22	3.69	20.36	75.95	6.0E-19	1.1E-37	2.4E-31	0.10	0.10	0.09	0.09	0.10
White Slough	WHITESL_LEN	20.35	16.73	61.67	1.25	4.8E-03	2.4E-04	33.31	13.41	23.49	29.78	3.9E-04	3.2E-03	15.53	1.33	83.05	0.09	1.2E-03	2.0E-03	9.35	8.62	81.98	0.04	3.7E-04	7.1E-04	0.10	0.24	0.09	0.09	0.13
White Slough DS Disappointment Sl.	WHTSLDISPONT_LEN	10.09	24.12	65.07	0.71	4.1E-03	1.9E-04	17.00	13.60	32.29	37.10	1.4E-03	0.01	7.70	1.46	90.83	1.5E-03	1.3E-03	2.2E-03	5.21	9.69	85.06	0.03	9.7E-04	2.1E-03	0.10	0.28	0.09	0.09	0.14

2

1 **Table 6D.5 Selenium Bioaccumulation from Water (µg/L) to Particulates and Fish (µg/g, dw) Using Models 1 and 2**

DSM2 Delta Water Location	Year 2000									Year 2005						Year 2007								
	Concentration					Whole-body Bass ^a	Fish-to-Bass Ratio		Concentration					Whole-body Bass ^a	Fish-to-Bass Ratio		Concentration					Whole-body Bass ^a	Fish-to-Bass Ratio	
	DSM2 Water	Particulate from Water	Invert. from Particulate	Model 1 Fish	Model 2 Fish		Model 1	Model 2	DSM2 Water	Particulate from Water	Invert. from Particulate	Model 1 Fish	Model 2 Fish		Model 1	Model 2	DSM2 Water	Particulate from Water	Invert. from Particulate	Model 1 Fish	Model 2 Fish		Model 1	Model 2
	First Quarter									First Quarter						First Quarter								
Sacramento River RM 44	0.09	0.09	0.25	0.27	0.30	2.6	0.10	0.11	0.09	0.09	0.25	0.28	0.31	1.5	0.19	0.21	0.09	0.09	0.25	0.28	0.31	1.8	0.15	0.17
Cache Slough Rye ^b	0.10	0.10	0.28	0.31	0.34	1.5	0.21	0.23	0.09	0.09	0.26	0.29	0.31	1.7	0.17	0.18	0.09	0.09	0.26	0.28	0.31	2.5	0.11	0.12
San Joaquin River Potato Slough	0.17	0.17	0.47	0.52	0.57	1.4	0.38	0.42	0.14	0.14	0.40	0.44	0.48	1.3	0.33	0.37	0.09	0.09	0.26	0.28	0.31	2.5	0.11	0.13
Franks Tract	0.19	0.19	0.53	0.58	0.64	1.6	0.35	0.39	0.15	0.15	0.41	0.45	0.49	1.1	0.39	0.43	0.09	0.09	0.26	0.29	0.32	3.0	0.10	0.11
Big Break	0.13	0.13	0.35	0.39	0.43	1.6	0.25	0.28	0.11	0.11	0.31	0.34	0.37	1.0	0.33	0.37	0.09	0.09	0.26	0.28	0.31	2.8	0.10	0.11
Middle River Bullfrog	0.31	0.31	0.86	0.95	1.05	NA	NA	NA	0.46	0.46	1.29	1.42	1.56	1.9	0.7	0.8	0.20	0.20	0.55	0.61	0.67	2.1	0.3	0.3
Old River near Paradise Cut ^c	0.73	0.73	2.05	2.25	2.48	NA	NA	NA	0.78	0.78	2.19	2.41	2.66	2.4	1.0	1.1	0.56	0.56	1.57	1.73	1.90	NA	NA	NA
Knights Landing ^d	0.23	0.23	0.64	0.71	0.78	NA	NA	NA	0.23	0.23	0.64	0.71	0.78	2.2	0.3	0.4	0.23	0.23	0.64	0.71	0.78	NA	NA	NA
Vernalis ^e	0.83	0.83	2.32	2.56	2.81	1.7	1.50	1.65	0.85	0.85	2.38	2.62	2.88	1.9	1.38	1.52	0.58	0.58	1.62	1.79	1.97	2.4	0.74	0.82
	Second Quarter									Second Quarter						Second Quarter								
Sacramento River RM 44	0.09	0.09	0.25	0.28	0.30	2.6	0.11	0.12	0.09	0.09	0.25	0.28	0.30	1.5	0.19	0.21	0.09	0.09	0.25	0.28	0.31	1.8	0.15	0.17
Cache Slough Rye ^b	0.11	0.11	0.32	0.35	0.38	1.5	0.23	0.26	0.10	0.10	0.27	0.30	0.33	1.7	0.17	0.19	0.10	0.10	0.29	0.32	0.35	2.5	0.12	0.14
San Joaquin River Potato Slough	0.24	0.24	0.67	0.74	0.81	1.4	0.54	0.60	0.36	0.36	1.02	1.12	1.23	1.3	0.86	0.94	0.13	0.13	0.38	0.42	0.46	2.5	0.17	0.18
Franks Tract	0.27	0.27	0.76	0.83	0.92	1.6	0.51	0.56	0.49	0.49	1.36	1.50	1.65	1.1	1.31	1.44	0.14	0.14	0.39	0.43	0.47	3.0	0.14	0.16
Big Break	0.20	0.20	0.55	0.60	0.66	1.6	0.39	0.43	0.30	0.30	0.83	0.91	1.00	1.0	0.89	0.98	0.12	0.12	0.33	0.36	0.39	2.8	0.13	0.14
Middle River Bullfrog	0.61	0.61	1.71	1.88	2.07	NA	NA	NA	0.75	0.75	2.09	2.30	2.53	1.9	1.2	1.3	0.29	0.29	0.82	0.90	0.99	2.1	0.4	0.5
Old River near Paradise Cut ^c	0.68	0.68	1.89	2.08	2.29	NA	NA	NA	0.84	0.84	2.35	2.59	2.84	2.4	1.1	1.2	0.43	0.43	1.22	1.34	1.47	NA	NA	NA
Knights Landing ^d	0.23	0.23	0.64	0.71	0.78	NA	NA	NA	0.23	0.23	0.64	0.71	0.78	2.2	0.3	0.4	0.23	0.23	0.64	0.71	0.78	NA	NA	NA
Vernalis ^e	0.83	0.83	2.32	2.56	2.81	1.7	1.50	1.65	0.85	0.85	2.38	2.62	2.88	1.9	1.38	1.52	0.58	0.58	1.62	1.79	1.97	2.4	0.74	0.82
	Third Quarter									Third Quarter						Third Quarter								
Sacramento River RM 44	0.09	0.09	0.25	0.28	0.30	2.6	0.11	0.12	0.09	0.09	0.25	0.28	0.31	1.5	0.19	0.21	0.09	0.09	0.25	0.28	0.31	1.8	0.15	0.17
Cache Slough Rye ^b	0.11	0.11	0.31	0.34	0.37	1.5	0.22	0.25	0.09	0.09	0.25	0.28	0.31	1.7	0.16	0.18	0.10	0.10	0.29	0.32	0.35	2.5	0.13	0.14
San Joaquin River Potato Slough	0.10	0.10	0.27	0.30	0.32	1.4	0.22	0.24	0.10	0.10	0.27	0.30	0.33	1.3	0.23	0.25	0.10	0.10	0.27	0.30	0.33	2.5	0.12	0.13
Franks Tract	0.10	0.10	0.28	0.31	0.34	1.6	0.19	0.20	0.11	0.11	0.29	0.32	0.36	1.1	0.28	0.31	0.10	0.10	0.28	0.31	0.34	3.0	0.10	0.11
Big Break	0.10	0.10	0.29	0.32	0.35	1.6	0.20	0.22	0.10	0.10	0.29	0.32	0.35	1.0	0.31	0.35	0.10	0.10	0.28	0.31	0.34	2.8	0.11	0.12
Middle River Bullfrog	0.20	0.20	0.57	0.63	0.69	NA	NA	NA	0.30	0.30	0.83	0.91	1.01	1.9	0.5	0.5	0.12	0.12	0.32	0.36	0.39	2.1	0.2	0.2
Old River near Paradise Cut ^c	0.75	0.75	2.11	2.32	2.55	NA	NA	NA	0.80	0.80	2.24	2.47	2.71	2.4	1.0	1.1	0.53	0.53	1.49	1.64	1.80	NA	NA	NA
Knights Landing ^d	0.23	0.23	0.64	0.71	0.78	NA	NA	NA	0.23	0.23	0.64	0.71	0.78	2.2	0.3	0.4	0.23	0.23	0.64	0.71	0.78	NA	NA	NA
Vernalis ^e	0.83	0.83	2.32	2.56	2.81	1.7	1.50	1.65	0.85	0.85	2.38	2.62	2.88	1.9	1.38	1.52	0.58	0.58	1.62	1.79	1.97	2.4	0.74	0.82

2

DSM2 Delta Water Location	Year 2000									Year 2005						Year 2007								
	Concentration					Whole-body Bass ^a	Fish-to-Bass Ratio		Concentration					Whole-body Bass ^a	Fish-to-Bass Ratio		Concentration					Whole-body Bass ^a	Fish-to-Bass Ratio	
	DSM2 Water	Particulate from Water	Invert. from Particulate	Model 1 Fish	Model 2 Fish		Model 1	Model 2	DSM2 Water	Particulate from Water	Invert. from Particulate	Model 1 Fish	Model 2 Fish		Model 1	Model 2	DSM2 Water	Particulate from Water	Invert. from Particulate	Model 1 Fish	Model 2 Fish		Model 1	Model 2
	Fourth Quarter									Fourth Quarter						Fourth Quarter								
Sacramento River RM 44	0.09	0.09	0.25	0.28	0.30	2.6	0.11	0.12	0.09	0.09	0.25	0.28	0.31	1.5	0.19	0.21	0.09	0.09	0.25	0.28	0.30	1.8	0.15	0.17
Cache Slough Ryer ^b	0.10	0.10	0.29	0.31	0.35	1.5	0.21	0.23	0.09	0.09	0.26	0.28	0.31	1.7	0.16	0.18	0.10	0.10	0.28	0.31	0.34	2.5	0.12	0.13
San Joaquin River Potato Slough	0.09	0.09	0.26	0.29	0.32	1.4	0.21	0.23	0.09	0.09	0.25	0.28	0.31	1.3	0.21	0.24	0.09	0.09	0.26	0.29	0.32	2.5	0.12	0.13
Franks Tract	0.10	0.10	0.27	0.29	0.32	1.6	0.18	0.20	0.09	0.09	0.26	0.28	0.31	1.1	0.25	0.27	0.10	0.10	0.27	0.30	0.32	3.0	0.10	0.11
Big Break	0.10	0.10	0.27	0.30	0.33	1.6	0.19	0.21	0.09	0.09	0.26	0.28	0.31	1.0	0.28	0.31	0.10	0.10	0.27	0.30	0.33	2.8	0.11	0.12
Middle River Bullfrog	0.30	0.30	0.84	0.92	1.01	NA	NA	NA	0.24	0.24	0.68	0.74	0.82	1.9	0.4	0.4	0.17	0.17	0.47	0.52	0.57	2.1	0.2	0.3
Old River near Paradise Cut ^c	0.81	0.81	2.27	2.50	2.75	NA	NA	NA	0.72	0.72	2.01	2.21	2.43	2.4	0.9	1.0	0.57	0.57	1.59	1.75	1.93	NA	NA	NA
Knights Landing ^d	0.23	0.23	0.64	0.71	0.78	NA	NA	NA	0.23	0.23	0.64	0.71	0.78	2.2	0.3	0.4	0.23	0.23	0.64	0.71	0.78	NA	NA	NA
Vernalis ^e	0.83	0.83	2.32	2.56	2.81	1.7	1.50	1.65	0.85	0.85	2.38	2.62	2.88	1.9	1.38	1.52	0.58	0.58	1.62	1.79	1.97	2.4	0.74	0.82

Notes:
 Equations from Presser and Luoma (2010a, 2010b) were used to calculate selenium concentrations for fish. Models 1 and 2 used the default (1.00) and the average selenium trophic transfer factors to aquatic insects (2.8) and fish (1.1 for all trophic levels).
 Model 1 = TL-3 Fish Eating Invertebrates
 Model 2 = TL-4 Fish Eating TL-3 Fish
 Invert. = invertebrate
 K_d = particulate concentration/water concentration ratio
 µg/g, dw = micrograms per gram, dry weight
 NA = not available; bass not collected here
 RM = river mile
 TL = trophic level
 a. Geometric mean calculated from whole-body largemouth bass data presented in Foe (2010a).
 b. Fish data collected at Rio Vista (Foe 2010a) were used to calculate geometric mean whole-body largemouth bass and ratios.
 c. Fish data collected at Old River near Tracy (Foe 2010a) were used to calculate geometric mean whole-body largemouth bass and ratios.
 d. Geometric mean of total selenium concentrations in water collected from years 2004, 2007, and 2008 (DWR Website 2009) was used to estimate selenium concentrations in particulates and biota (DSM2 data were not available). Fish data collected from Sacramento River at Veterans Bridge (Foe 2010a) were used to calculate mean whole-body largemouth bass and ratios.
 e. Geometric mean of selenium concentrations (total or dissolved was not specified) in water collected from years 1999–2000 (SWAMP Website 2009) was used to estimate Year 2000 selenium concentrations in particulates and biota (DSM2 data were not available); years 2004-2005 were used for Year 2005 estimates; and years 2007 were used for Year 2007 estimates.

1 **Table 6D.6 Selenium Bioaccumulation from Water (µg/L) to Particulates and Fish (µg/g, dw) Using Model 2 with Estimated K_d from All Years Regression for Model 3**

DSM2 Delta Water Location	Year 2000							Year 2005						Year 2007							
	Concentration				K _d	Whole-body Bass ^a	Fish-to-Bass Ratio Model 3	Concentration				K _d	Whole-body Bass ^a	Fish-to-Bass Ratio Model 3	Concentration				K _d	Whole-body Bass ^a	Fish-to-Bass Ratio Model 3
	DSM2 Water	Particulate from Water	Invert. from Particulate	Model 3 Fish				DSM2 Water	Particulate from Water	Invert. from Particulate	Model 3 Fish				DSM2 Water	Particulate from Water	Invert. from Particulate	Model 3 Fish			
	First Quarter							First Quarter						First Quarter							
Sacramento River RM 44	0.09	0.54	1.50	1.81	6060	2.6	0.69	0.09	0.54	1.50	1.81	5945	1.5	1.25	0.09	0.54	1.50	1.81	5946	1.8	0.98
Cache Slough Ryer ^b	0.10	0.54	1.50	1.82	5389	1.5	1.22	0.09	0.54	1.50	1.82	5783	1.7	1.05	0.09	0.54	1.50	1.81	5852	2.5	0.71
San Joaquin River Potato Slough	0.17	0.55	1.53	1.85	3229	1.4	1.36	0.14	0.54	1.52	1.84	3824	1.3	1.41	0.09	0.54	1.50	1.81	5819	2.5	0.73
Franks Tract	0.19	0.55	1.53	1.85	2904	1.6	1.13	0.15	0.54	1.52	1.84	3724	1.1	1.61	0.09	0.54	1.50	1.82	5762	3.0	0.61
Big Break	0.13	0.54	1.51	1.83	4295	1.6	1.18	0.11	0.54	1.51	1.82	4873	1.0	1.79	0.09	0.54	1.50	1.81	5850	2.8	0.64
Middle River Bullfrog	0.31	0.56	1.56	1.88	1801	NA	NA	0.46	0.56	1.57	1.90	1221	1.9	1.0	0.20	0.55	1.53	1.86	2773	2.1	0.87
Old River near Paradise Cut ^c	0.73	0.57	1.60	1.93	780	NA	NA	0.78	0.57	1.60	1.94	729	2.4	0.8	0.56	0.57	1.58	1.92	1007	NA	NA
Knights Landing ^d	0.23	0.55	1.54	1.87	2394	NA	NA	0.23	0.55	1.54	1.87	2394	2.2	0.8	0.23	0.55	1.54	1.87	2394	NA	NA
Vernalis ^e	0.83	0.57	1.60	1.94	689	1.7	1.14	0.85	0.57	1.60	1.94	674	1.9	1.02	0.58	0.57	1.59	1.92	976	2.4	0.80
	Second Quarter							Second Quarter						Second Quarter							
Sacramento River RM 44	0.09	0.54	1.50	1.81	5952	2.6	0.69	0.09	0.54	1.50	1.81	5947	1.5	1.25	0.09	0.54	1.50	1.81	5944	1.8	0.98
Cache Slough Ryer ^b	0.11	0.54	1.51	1.83	4777	1.5	1.22	0.10	0.54	1.50	1.82	5538	1.7	1.05	0.10	0.54	1.50	1.82	5241	2.5	0.72
San Joaquin River Potato Slough	0.24	0.55	1.54	1.87	2309	1.4	1.38	0.36	0.56	1.56	1.89	1537	1.3	1.45	0.13	0.54	1.52	1.84	4020	2.5	0.74
Franks Tract	0.27	0.55	1.55	1.87	2048	1.6	1.14	0.49	0.56	1.58	1.91	1159	1.1	1.67	0.14	0.54	1.52	1.84	3921	3.0	0.61
Big Break	0.20	0.55	1.53	1.86	2800	1.6	1.20	0.30	0.55	1.55	1.88	1876	1.0	1.84	0.12	0.54	1.51	1.83	4645	2.8	0.64
Middle River Bullfrog	0.61	0.57	1.59	1.92	928	NA	NA	0.75	0.57	1.60	1.93	764	1.9	1.0	0.29	0.55	1.55	1.88	1896	2.1	0.9
Old River near Paradise Cut ^c	0.68	0.57	1.59	1.93	842	NA	NA	0.84	0.57	1.60	1.94	682	2.4	0.8	0.43	0.56	1.57	1.90	1291	NA	NA
Knights Landing ^d	0.23	0.55	1.54	1.87	2394	NA	NA	0.23	0.55	1.54	1.87	2394	2.2	0.8	0.23	0.55	1.54	1.87	2394	NA	NA
Vernalis ^e	0.83	0.57	1.60	1.94	689	1.7	1.14	0.85	0.57	1.60	1.94	674	1.9	1.02	0.58	0.57	1.59	1.92	976	2.4	0.80
	Third Quarter							Third Quarter						Third Quarter							
Sacramento River RM 44	0.09	0.54	1.50	1.81	5947	2.6	0.69	0.09	0.54	1.50	1.81	5946	1.5	1.25	0.09	0.54	1.50	1.81	5946	1.8	0.98
Cache Slough Ryer ^b	0.11	0.54	1.51	1.82	4942	1.5	1.22	0.09	0.54	1.50	1.81	5914	1.7	1.05	0.10	0.54	1.51	1.82	5184	2.5	0.72
San Joaquin River Potato Slough	0.10	0.54	1.50	1.82	5592	1.4	1.34	0.10	0.54	1.50	1.82	5523	1.3	1.39	0.10	0.54	1.50	1.82	5557	2.5	0.73
Franks Tract	0.10	0.54	1.50	1.82	5412	1.6	1.10	0.11	0.54	1.51	1.82	5121	1.1	1.59	0.10	0.54	1.50	1.82	5393	3.0	0.61
Big Break	0.10	0.54	1.50	1.82	5227	1.6	1.17	0.10	0.54	1.51	1.82	5159	1.0	1.79	0.10	0.54	1.50	1.82	5291	2.8	0.64
Middle River Bullfrog	0.20	0.55	1.54	1.86	2688	NA	NA	0.30	0.55	1.55	1.88	1868	1.9	1.0	0.12	0.54	1.51	1.83	4656	2.1	0.86
Old River near Paradise Cut ^c	0.75	0.57	1.60	1.93	757	NA	NA	0.80	0.57	1.60	1.94	714	2.4	0.8	0.53	0.56	1.58	1.91	1061	NA	NA
Knights Landing ^d	0.23	0.55	1.54	1.87	2394	NA	NA	0.23	0.55	1.54	1.87	2394	2.2	0.8	0.23	0.55	1.54	1.87	2394	NA	NA
Vernalis ^e	0.83	0.57	1.60	1.94	689	1.7	1.14	0.85	0.57	1.60	1.94	674	1.9	1.02	0.58	0.57	1.59	1.92	976	2.4	0.80

2

DSM2 Delta Water Location	Year 2000							Year 2005						Year 2007							
	Concentration				K _d	Whole-body Bass ^a	Fish-to-Bass Ratio	Concentration				K _d	Whole-body Bass ^a	Fish-to-Bass Ratio	Concentration				K _d	Whole-body Bass ^a	Fish-to-Bass Ratio
	DSM2 Water	Particulate from Water	Invert. from Particulate	Model 3 Fish			Model 3	DSM2 Water	Particulate from Water	Invert. from Particulate	Model 3 Fish			Model 3	DSM2 Water	Particulate from Water	Invert. from Particulate	Model 3 Fish			Model 3
	Fourth Quarter							Fourth Quarter						Fourth Quarter							
Sacramento River RM 44	0.09	0.54	1.50	1.81	5948	2.6	0.69	0.09	0.54	1.50	1.81	5946	1.5	1.25	0.09	0.54	1.50	1.81	5947	1.8	0.98
Cache Slough Ryer ^b	0.10	0.54	1.50	1.82	5261	1.5	1.22	0.09	0.54	1.50	1.81	5830	1.7	1.05	0.10	0.54	1.50	1.82	5345	2.5	0.71
San Joaquin River Potato Slough	0.09	0.54	1.50	1.82	5704	1.4	1.34	0.09	0.54	1.50	1.81	5885	1.3	1.39	0.09	0.54	1.50	1.82	5678	2.5	0.73
Franks Tract	0.10	0.54	1.50	1.82	5621	1.6	1.10	0.09	0.54	1.50	1.81	5859	1.1	1.59	0.10	0.54	1.50	1.82	5596	3.0	0.61
Big Break	0.10	0.54	1.50	1.82	5534	1.6	1.17	0.09	0.54	1.50	1.82	5809	1.0	1.78	0.10	0.54	1.50	1.82	5470	2.8	0.64
Middle River Bullfrog	0.30	0.55	1.55	1.88	1859	NA	NA	0.24	0.55	1.54	1.87	2283	1.9	1.0	0.17	0.55	1.53	1.85	3241	2.1	0.87
Old River near Paradise Cut ^c	0.81	0.57	1.60	1.94	704	NA	NA	0.72	0.57	1.60	1.93	795	2.4	0.8	0.57	0.57	1.58	1.92	994	NA	NA
Knights Landing ^d	0.23	0.55	1.54	1.87	2394	NA	NA	0.23	0.55	1.54	1.87	2394	2.2	0.8	0.23	0.55	1.54	1.87	2394	NA	NA
Vernalis ^e	0.83	0.57	1.60	1.94	689	1.7	1.14	0.85	0.57	1.60	1.94	674	1.9	1.02	0.58	0.57	1.59	1.92	976	2.4	0.80

Notes:
 Equations from Presser and Luoma (2010a, 2010b) were used to calculate selenium concentrations for fish. Model 3 uses average selenium trophic transfer factors to aquatic insects (2.8) and fish (1.1 for all trophic levels).
 Model 3 = Model 2 (TL-4 Fish Eating TL-3 Fish) with K estimated using all years regression (log K = 2.76-0.97(logDSM2))
 Invert. = invertebrate
 K_d = particulate concentration/water concentration ratio
 µg/g, dw = micrograms per gram, dry weight
 NA = not available; bass not collected here
 RM = river mile
 TL = trophic level
 a. Geometric mean calculated from whole-body largemouth bass data presented in Foe (2010a).
 b. Fish data collected at Rio Vista (Foe 2010a) were used to calculate geometric mean whole-body largemouth bass and ratios.
 c. Fish data collected at Old River near Tracy (Foe 2010a) were used to calculate geometric mean whole-body largemouth bass and ratios.
 d. Geometric mean of total selenium concentrations in water collected from years 2004, 2007, and 2008 (DWR Website 2009) was used to estimate selenium concentrations in particulates and biota (DSM2 data were not available). Fish data collected from Sacramento River at Veterans Bridge (Foe 2010a) were used to calculate geometric mean whole-body largemouth bass and ratios.
 e. Geometric mean of selenium concentrations (total or dissolved was not specified) in water collected from years 1990-2000 (SWAMP Website 2009) was used to estimate Year 2000 selenium concentrations in particulates and biota (DSM2 data were not available). Years 2004-2005 were used for Year 2005 estimates; and years 2007 were used for Year 2007 estimates.

1 **Table 6D.7 Selenium Bioaccumulation from Water (µg/L) to Particulates and Fish (µg/g, dw) Using Model 2 with Estimated K_d from Normal/Wet Years Regression for Model 4 and Dry Years Regression for Model 5**

DSM2 Delta Water Location	Year 2000							Year 2005						Year 2007							
	Concentration				K _d	Whole-body Bass ^a	Fish-to-Bass Ratio	Concentration				K _d	Whole-body Bass ^a	Fish-to-Bass Ratio	Concentration				K _d	Whole-body Bass ^a	Fish-to-Bass Ratio
	DSM2 Water	Particulate from Water	Invert. from Particulate	Model 4 Fish				DSM2 Water	Particulate from Water	Invert. from Particulate	Model 4 Fish				DSM2 Water	Particulate from Water	Invert. from Particulate	Model 5 Fish			
	First Quarter							First Quarter						First Quarter							
Sacramento River RM 44	0.09	0.44	1.24	1.49	4997	2.6	0.57	0.09	0.44	1.24	1.50	4909	1.5	1.03	0.09	0.73	2.03	2.46	8063	1.8	1.33
Cache Slough Ryer ^b	0.10	0.45	1.25	1.51	4481	1.5	1.01	0.09	0.44	1.24	1.50	4784	1.7	0.87	0.09	0.73	2.03	2.46	7929	2.5	0.97
San Joaquin River Potato Slough	0.17	0.47	1.32	1.59	2786	1.4	1.17	0.14	0.46	1.30	1.57	3260	1.3	1.20	0.09	0.73	2.03	2.46	7883	2.5	0.99
Franks Tract	0.19	0.48	1.33	1.61	2525	1.6	0.98	0.15	0.46	1.30	1.57	3181	1.1	1.37	0.09	0.73	2.03	2.46	7802	3.0	0.82
Big Break	0.13	0.46	1.28	1.55	3630	1.6	1.00	0.11	0.45	1.26	1.53	4082	1.0	1.50	0.09	0.73	2.03	2.46	7926	2.8	0.87
Middle River Bullfrog	0.31	0.50	1.40	1.69	1621	NA	NA	0.46	0.52	1.46	1.76	1130	1.9	0.9	0.20	0.71	2.00	2.42	3616	2.1	1.14
Old River near Paradise Cut ^c	0.73	0.55	1.53	1.85	745	NA	NA	0.78	0.55	1.54	1.86	700	2.4	0.8	0.56	0.70	1.96	2.37	1247	NA	NA
Knights Landing ^d	0.23	0.49	1.36	1.64	2111	NA	NA	0.23	0.49	1.36	1.64	2111	2.2	0.7	0.23	0.71	1.99	2.41	3098	NA	NA
Vernalis ^e	0.83	0.55	1.55	1.87	665	1.7	1.10	0.85	0.55	1.55	1.87	651	1.9	0.99	0.58	0.70	1.96	2.37	1206	2.4	0.99
	Second Quarter							Second Quarter						Second Quarter							
Sacramento River RM 44	0.09	0.44	1.24	1.50	4914	2.6	0.57	0.09	0.44	1.24	1.50	4910	1.5	1.03	0.09	0.73	2.03	2.46	8061	1.8	1.33
Cache Slough Ryer ^b	0.11	0.45	1.27	1.53	4007	1.5	1.03	0.10	0.45	1.25	1.51	4596	1.7	0.87	0.10	0.72	2.03	2.45	7061	2.5	0.96
San Joaquin River Potato Slough	0.24	0.49	1.36	1.65	2041	1.4	1.22	0.36	0.51	1.42	1.72	1399	1.3	1.32	0.13	0.72	2.02	2.44	5343	2.5	0.98
Franks Tract	0.27	0.49	1.38	1.67	1826	1.6	1.02	0.49	0.52	1.46	1.77	1077	1.1	1.55	0.14	0.72	2.02	2.44	5204	3.0	0.82
Big Break	0.20	0.48	1.34	1.62	2441	1.6	1.04	0.30	0.50	1.39	1.69	1683	1.0	1.65	0.12	0.72	2.02	2.45	6220	2.8	0.86
Middle River Bullfrog	0.61	0.54	1.50	1.81	876	NA	NA	0.75	0.55	1.53	1.85	732	1.9	1.0	0.29	0.71	1.99	2.40	2424	2.1	1.1
Old River near Paradise Cut ^c	0.68	0.54	1.51	1.83	801	NA	NA	0.84	0.55	1.55	1.87	658	2.4	0.8	0.43	0.70	1.97	2.38	1617	NA	NA
Knights Landing ^d	0.23	0.49	1.36	1.64	2111	NA	NA	0.23	0.49	1.36	1.64	2111	2.2	0.7	0.23	0.71	1.99	2.41	3098	NA	NA
Vernalis ^e	0.83	0.55	1.55	1.87	665	1.7	1.10	0.85	0.55	1.55	1.87	651	1.9	0.99	0.58	0.70	1.96	2.37	1206	2.4	0.99
	Third Quarter							Third Quarter						Third Quarter							
Sacramento River RM 44	0.09	0.44	1.24	1.50	4910	2.6	0.57	0.09	0.44	1.24	1.50	4910	1.5	1.03	0.09	0.73	2.03	2.46	8064	1.8	1.33
Cache Slough Ryer ^b	0.11	0.45	1.26	1.53	4135	1.5	1.02	0.09	0.44	1.24	1.50	4885	1.7	0.87	0.10	0.72	2.03	2.45	6980	2.5	0.96
San Joaquin River Potato Slough	0.10	0.44	1.25	1.51	4637	1.4	1.11	0.10	0.45	1.25	1.51	4584	1.3	1.15	0.10	0.72	2.03	2.46	7510	2.5	0.99
Franks Tract	0.10	0.45	1.25	1.51	4499	1.6	0.92	0.11	0.45	1.26	1.52	4274	1.1	1.33	0.10	0.72	2.03	2.45	7276	3.0	0.82
Big Break	0.10	0.45	1.25	1.52	4356	1.6	0.98	0.10	0.45	1.26	1.52	4304	1.0	1.49	0.10	0.72	2.03	2.45	7131	2.8	0.87
Middle River Bullfrog	0.20	0.48	1.34	1.63	2350	NA	NA	0.30	0.50	1.39	1.69	1677	1.9	0.9	0.12	0.72	2.02	2.45	6235	2.1	1.15
Old River near Paradise Cut ^c	0.75	0.55	1.53	1.85	725	NA	NA	0.80	0.55	1.54	1.86	687	2.4	0.8	0.53	0.70	1.96	2.37	1317	NA	NA
Knights Landing ^d	0.23	0.49	1.36	1.64	2111	NA	NA	0.23	0.49	1.36	1.64	2111	2.2	0.7	0.23	0.71	1.99	2.41	3098	NA	NA
Vernalis ^e	0.83	0.55	1.55	1.87	665	1.7	1.10	0.85	0.55	1.55	1.87	651	1.9	0.99	0.58	0.70	1.96	2.37	1206	2.4	0.99

2

DSM2 Delta Water Location	Year 2000							Year 2005						Year 2007							
	Concentration				K _d	Whole-body Bass ^a	Fish-to-Bass Ratio	Concentration				K _d	Whole-body Bass ^a	Fish-to-Bass Ratio	Concentration				K _d	Whole-body Bass ^a	Fish-to-Bass Ratio
	DSM2 Water	Particulate from Water	Invert. from Particulate	Model 4 Fish			Model 4	DSM2 Water	Particulate from Water	Invert. from Particulate	Model 4 Fish			Model 4	DSM2 Water	Particulate from Water	Invert. from Particulate	Model 5 Fish			Model 5
	Fourth Quarter							Fourth Quarter						Fourth Quarter							
Sacramento River RM 44	0.09	0.44	1.24	1.50	4911	2.6	0.57	0.09	0.44	1.24	1.50	4909	1.5	1.03	0.09	0.73	2.03	2.46	8064	1.8	1.33
Cache Slough Ryer ^b	0.10	0.45	1.25	1.52	4383	1.5	1.02	0.09	0.44	1.24	1.50	4820	1.7	0.87	0.10	0.72	2.03	2.45	7209	2.5	0.96
San Joaquin River Potato Slough	0.09	0.44	1.24	1.50	4723	1.4	1.11	0.09	0.44	1.24	1.50	4862	1.3	1.15	0.09	0.73	2.03	2.46	7682	2.5	0.99
Franks Tract	0.10	0.44	1.24	1.51	4660	1.6	0.91	0.09	0.44	1.24	1.50	4843	1.1	1.31	0.10	0.73	2.03	2.46	7564	3.0	0.82
Big Break	0.10	0.45	1.25	1.51	4593	1.6	0.97	0.09	0.44	1.24	1.50	4804	1.0	1.47	0.10	0.72	2.03	2.46	7386	2.8	0.87
Middle River Bullfrog	0.30	0.50	1.40	1.69	1669	NA	NA	0.24	0.49	1.37	1.65	2020	1.9	0.9	0.17	0.72	2.01	2.43	4260	2.1	1.14
Old River near Paradise Cut ^c	0.81	0.55	1.54	1.87	678	NA	NA	0.72	0.54	1.52	1.84	759	2.4	0.8	0.57	0.70	1.96	2.37	1229	NA	NA
Knights Landing ^d	0.23	0.49	1.36	1.64	2111	NA	NA	0.23	0.49	1.36	1.64	2111	2.2	0.7	0.23	0.71	1.99	2.41	3098	NA	NA
Vernalis ^e	0.83	0.55	1.55	1.87	665	1.7	1.10	0.85	0.55	1.55	1.87	651	1.9	0.99	0.58	0.70	1.96	2.37	1206	2.4	0.99

Notes:
 Equations from Presser and Luoma (2010a, 2010b) were used to calculate selenium concentrations for fish. Models 4 and 5 used the average selenium trophic transfer factors to aquatic insects (2.8) and fish (1.1 for all trophic levels).
 Model 4 = Model 2 (TL-4 Fish Eating TL-3 Fish) with K estimated using normal/wet years regression (log K= 2.75-0.90(logDSM2))
 Model 5 = Model 2 (TL-4 Fish Eating TL-3 Fish) with K estimated using dry years (2007) regression (log K= 2.84-1.02(logDSM2))
 Invert. = invertebrate
 K_d = particulate concentration/water concentration ratio
 µg/g, dw = micrograms per gram, dry weight
 NA = not available; bass not collected here
 RM = river mile
 TL = trophic level
 a. Geometric mean calculated from whole-body largemouth bass data presented in Foe (2010a).
 b. Fish data collected at Rio Vista (Foe 2010a) were used to calculate geometric mean whole-body largemouth bass and ratios.
 c. Fish data collected at Old River near Tracy (Foe 2010a) were used to calculate geometric mean whole-body largemouth bass and ratios.
 d. Geometric mean of total selenium concentrations in water collected from years 2004, 2007, and 2008 (DWR Website 2009) was used to estimate selenium concentrations in particulates and biota (DSM2 data were not available). Fish data collected from Sacramento River at Veterans Bridge (Foe 2010a) were used to calculate geometric mean whole-body largemouth bass and ratios.
 e. Geometric mean of selenium concentrations (total or dissolved was not specified) in water collected from years 1990-2000 (SWAMP Website 2009) was used to estimate Year 2000 selenium concentrations in particulates and biota (DSM2 data were not available). Years 2004-2005 were used for Year 2005 estimates; and years 2007 were used for Year 2007 estimates.

1
2

Table 6D.8 Selenium Bioaccumulation from Water (µg/L) to Particulates, Whole-body Fish (µg/g, dw), and Bird Eggs (µg/g, dw) Using Model 2 with Estimated K_d from Normal/Wet Years Regression for Model 4 and Dry Years Regression for Model 5

DSM2 Delta Water Location	Year 2000									Year 2005									Year 2007								
	Concentration				K _d	Whole-body Bass ^a	Fish-to-Bass Ratio Model 4	Bird Eggs		Concentration				K _d	Whole-body Bass ^a	Fish-to-Bass Ratio Model 4	Bird Eggs		Concentration				K _d	Whole-body Bass ^a	Fish-to-Bass Ratio Model 5	Bird Eggs	
	DSM2 Water	Particulate from Water	Invert. from Particulate	Model 4 Fish				From Invert.	From Fish	DSM2 Water	Particulate from Water	Invert. from Particulate	Model 4 Fish				From Invert.	From Fish	DSM2 Water	Particulate from Water	Invert. from Particulate	Model 5 Fish				From Invert.	From Fish
	First Quarter									First Quarter									First Quarter								
Sacramento River RM 44	0.09	0.44	1.24	1.49	4997	2.6	0.57	2.22	2.69	0.09	0.44	1.24	1.50	4909	1.5	1.03	2.23	2.70	0.09	0.73	2.03	2.46	8063	1.8	1.33	3.66	4.43
Cache Slough Ryer ^b	0.10	0.45	1.25	1.51	4481	1.5	1.01	2.25	2.72	0.09	0.44	1.24	1.50	4784	1.7	0.87	2.23	2.70	0.09	0.73	2.03	2.46	7929	2.5	0.97	3.66	4.43
San Joaquin River Potato Slough	0.17	0.47	1.32	1.59	2786	1.4	1.17	2.37	2.87	0.14	0.46	1.30	1.57	3260	1.3	1.20	2.33	2.82	0.09	0.73	2.03	2.46	7883	2.5	0.99	3.66	4.43
Franks Tract	0.19	0.48	1.33	1.61	2525	1.6	0.98	2.40	2.90	0.15	0.46	1.30	1.57	3181	1.1	1.37	2.34	2.83	0.09	0.73	2.03	2.46	7802	3.0	0.82	3.66	4.42
Big Break	0.13	0.46	1.28	1.55	3630	1.6	1.00	2.30	2.79	0.11	0.45	1.26	1.53	4082	1.0	1.50	2.27	2.75	0.09	0.73	2.03	2.46	7926	2.8	0.87	3.66	4.43
Middle River Bullfrog	0.31	0.50	1.40	1.69	1621	NA	NA	2.52	3.05	0.46	0.52	1.46	1.76	1130	1.9	0.9	2.62	3.17	0.20	0.71	2.00	2.42	3616	2.1	1.14	3.60	4.36
Old River near Paradise Cut ^c	0.73	0.55	1.53	1.85	745	NA	NA	2.75	3.32	0.78	0.55	1.54	1.86	700	2.4	0.8	2.77	3.35	0.56	0.70	1.96	2.37	1247	NA	NA	3.53	4.27
Knights Landing ^d	0.23	0.49	1.36	1.64	2111	NA	NA	2.45	2.96	0.23	0.49	1.36	1.64	2111	2.2	0.7	2.45	2.96	0.23	0.71	1.99	2.41	3098	NA	NA	3.59	4.34
Vernalis ^e	0.83	0.55	1.55	1.87	665	1.7	1.10	2.78	3.37	0.85	0.55	1.55	1.87	651	1.9	0.99	2.79	3.37	0.58	0.70	1.96	2.37	1206	2.4	0.99	3.53	4.27
	Second Quarter									Second Quarter									Second Quarter								
Sacramento River RM 44	0.09	0.44	1.24	1.50	4914	2.6	0.57	2.23	2.70	0.09	0.44	1.24	1.50	4910	1.5	1.03	2.23	2.70	0.09	0.73	2.03	2.46	8061	1.8	1.33	3.66	4.43
Cache Slough Ryer ^b	0.11	0.45	1.27	1.53	4007	1.5	1.03	2.28	2.76	0.10	0.45	1.25	1.51	4596	1.7	0.87	2.24	2.72	0.10	0.72	2.03	2.45	7061	2.5	0.96	3.65	4.42
San Joaquin River Potato Slough	0.24	0.49	1.36	1.65	2041	1.4	1.22	2.46	2.97	0.36	0.51	1.42	1.72	1399	1.3	1.32	2.56	3.10	0.13	0.72	2.02	2.44	5343	2.5	0.98	3.63	4.39
Franks Tract	0.27	0.49	1.38	1.67	1826	1.6	1.02	2.49	3.01	0.49	0.52	1.46	1.77	1077	1.1	1.55	2.64	3.19	0.14	0.72	2.02	2.44	5204	3.0	0.82	3.63	4.39
Big Break	0.20	0.48	1.34	1.62	2441	1.6	1.04	2.41	2.91	0.30	0.50	1.39	1.69	1683	1.0	1.65	2.51	3.04	0.12	0.72	2.02	2.45	6220	2.8	0.86	3.64	4.40
Middle River Bullfrog	0.61	0.54	1.50	1.81	876	NA	NA	2.70	3.26	0.75	0.55	1.53	1.85	732	1.9	1.0	2.75	3.33	0.29	0.71	1.99	2.40	2424	2.1	1.1	3.57	4.32
Old River near Paradise Cut ^c	0.68	0.54	1.51	1.83	801	NA	NA	2.73	3.30	0.84	0.55	1.55	1.87	658	2.4	0.8	2.79	3.37	0.43	0.70	1.97	2.38	1617	NA	NA	3.55	4.29
Knights Landing ^d	0.23	0.49	1.36	1.64	2111	NA	NA	2.45	2.96	0.23	0.49	1.36	1.64	2111	2.2	0.7	2.45	2.96	0.23	0.71	1.99	2.41	3098	NA	NA	3.59	4.34
Vernalis ^e	0.83	0.55	1.55	1.87	665	1.7	1.10	2.78	3.37	0.85	0.55	1.55	1.87	651	1.9	0.99	2.79	3.37	0.58	0.70	1.96	2.37	1206	2.4	0.99	3.53	4.27
	Third Quarter									Third Quarter									Third Quarter								
Sacramento River RM 44	0.09	0.44	1.24	1.50	4910	2.6	0.57	2.23	2.70	0.09	0.44	1.24	1.50	4910	1.5	1.03	2.23	2.70	0.09	0.73	2.03	2.46	8064	1.8	1.33	3.66	4.43
Cache Slough Ryer ^b	0.11	0.45	1.26	1.53	4135	1.5	1.02	2.27	2.75	0.09	0.44	1.24	1.50	4885	1.7	0.87	2.23	2.70	0.10	0.72	2.03	2.45	6980	2.5	0.96	3.65	4.41
San Joaquin River Potato Slough	0.10	0.44	1.25	1.51	4637	1.4	1.11	2.24	2.71	0.10	0.45	1.25	1.51	4584	1.3	1.15	2.24	2.72	0.10	0.72	2.03	2.46	7510	2.5	0.99	3.65	4.42
Franks Tract	0.10	0.45	1.25	1.51	4499	1.6	0.92	2.25	2.72	0.11	0.45	1.26	1.52	4274	1.1	1.33	2.26	2.74	0.10	0.72	2.03	2.45	7276	3.0	0.82	3.65	4.42
Big Break	0.10	0.45	1.25	1.52	4356	1.6	0.98	2.26	2.73	0.10	0.45	1.26	1.52	4304	1.0	1.49	2.26	2.74	0.10	0.72	2.03	2.45	7131	2.8	0.87	3.65	4.42
Middle River Bullfrog	0.20	0.48	1.34	1.63	2350	NA	NA	2.42	2.93	0.30	0.50	1.39	1.69	1677	1.9	0.9	2.51	3.04	0.12	0.72	2.02	2.45	6235	2.1	1.15	3.64	4.40
Old River near Paradise Cut ^c	0.75	0.55	1.53	1.85	725	NA	NA	2.76	3.33	0.80	0.55	1.54	1.86	687	2.4	0.8	2.77	3.35	0.53	0.70	1.96	2.37	1317	NA	NA	3.53	4.27
Knights Landing ^d	0.23	0.49	1.36	1.64	2111	NA	NA	2.45	2.96	0.23	0.49	1.36	1.64	2111	2.2	0.7	2.45	2.96	0.23	0.71	1.99	2.41	3098	NA	NA	3.59	4.34
Vernalis ^e	0.83	0.55	1.55	1.87	665	1.7	1.10	2.78	3.37	0.85	0.55	1.55	1.87	651	1.9	0.99	2.79	3.37	0.58	0.70	1.96	2.37	1206	2.4	0.99	3.53	4.27

3

DSM2 Delta Water Location	Year 2000									Year 2005									Year 2007								
	Concentration				K _d	Whole-body Bass ^a	Fish-to-Bass Ratio Model 4	Bird Eggs		Concentration				K _d	Whole-body Bass ^a	Fish-to-Bass Ratio Model 4	Bird Eggs		Concentration				K _d	Whole-body Bass ^a	Fish-to-Bass Ratio Model 5	Bird Eggs	
	DSM2 Water	Particulate from Water	Invert. from Particulate	Model 4 Fish				From Invert.	From Fish	DSM2 Water	Particulate from Water	Invert. from Particulate	Model 4 Fish				From Invert.	From Fish	DSM2 Water	Particulate from Water	Invert. from Particulate	Model 5 Fish				From Invert.	From Fish
	Fourth Quarter									Fourth Quarter									Fourth Quarter								
Sacramento River RM 44	0.09	0.44	1.24	1.50	4911	2.6	0.57	2.23	2.70	0.09	0.44	1.24	1.50	4909	1.5	1.03	2.23	2.70	0.09	0.73	2.03	2.46	8064	1.8	1.33	3.66	4.43
Cache Slough Ryer ^b	0.10	0.45	1.25	1.52	4383	1.5	1.02	2.26	2.73	0.09	0.44	1.24	1.50	4820	1.7	0.87	2.23	2.70	0.10	0.72	2.03	2.45	7209	2.5	0.96	3.65	4.42
San Joaquin River Potato Slough	0.09	0.44	1.24	1.50	4723	1.4	1.11	2.24	2.71	0.09	0.44	1.24	1.50	4862	1.3	1.15	2.23	2.70	0.09	0.73	2.03	2.46	7682	2.5	0.99	3.66	4.42
Franks Tract	0.10	0.44	1.24	1.51	4660	1.6	0.91	2.24	2.71	0.09	0.44	1.24	1.50	4843	1.1	1.31	2.23	2.70	0.10	0.73	2.03	2.46	7564	3.0	0.82	3.65	4.42
Big Break	0.10	0.45	1.25	1.51	4593	1.6	0.97	2.24	2.72	0.09	0.44	1.24	1.50	4804	1.0	1.47	2.23	2.70	0.10	0.72	2.03	2.46	7386	2.8	0.87	3.65	4.42
Middle River Bullfrog	0.30	0.50	1.40	1.69	1669	NA	NA	2.51	3.04	0.24	0.49	1.37	1.65	2020	1.9	0.9	2.46	2.98	0.17	0.72	2.01	2.43	4260	2.1	1.14	3.61	4.37
Old River near Paradise Cut ^c	0.81	0.55	1.54	1.87	678	NA	NA	2.78	3.36	0.72	0.54	1.52	1.84	759	2.4	0.8	2.74	3.32	0.57	0.70	1.96	2.37	1229	NA	NA	3.53	4.27
Knights Landing ^d	0.23	0.49	1.36	1.64	2111	NA	NA	2.45	2.96	0.23	0.49	1.36	1.64	2111	2.2	0.7	2.45	2.96	0.23	0.71	1.99	2.41	3098	NA	NA	3.59	4.34
Vernalis ^e	0.83	0.55	1.55	1.87	665	1.7	1.10	2.78	3.37	0.85	0.55	1.55	1.87	651	1.9	0.99	2.79	3.37	0.58	0.70	1.96	2.37	1206	2.4	0.99	3.53	4.27

Notes:
 Equations from Presser and Luoma (2010a, 2010b) were used to calculate selenium concentrations for fish. Models 4 and 5 used the average selenium trophic transfer factors to aquatic insects (2.8), fish (1.1 for all trophic levels) and bird eggs (1.8).
 Model 4 = Model 2 (TL-4 Fish Eating TL-3 Fish) with K estimated using normal/wet years regression (log K= 2.75-0.90(logDSM2))
 Model 5 = Model 2 (TL-4 Fish Eating TL-3 Fish) with K estimated using dry years (2007) regression (log K= 2.84-1.02(logDSM2))
 Invert. = invertebrate
 K_d = particulate concentration/water concentration ratio
 µg/g, dw = micrograms per gram, dry weight
 NA = not available; bass not collected here
 RM = river mile
 TL = trophic level
 a. Geometric mean calculated from whole-body largemouth bass data presented in Foe (2010a).
 b. Fish data collected at Rio Vista (Foe 2010a) were used to calculate geometric mean whole-body largemouth bass and ratios.
 c. Fish data collected at Old River near Tracy (Foe 2010a) were used to calculate geometric mean whole-body largemouth bass and ratios.
 d. Geometric mean of total selenium concentrations in water collected from years 2004, 2007, and 2008 (DWR Website 2009) was used to estimate selenium concentrations in particulates and biota (DSM2 data were not available). Fish data collected from Sacramento River at Veterans Bridge (Foe 2010a) were used to calculate geometric mean whole-body largemouth bass and ratios.
 e. Geometric mean of selenium concentrations (total or dissolved was not specified) in water collected from years 1990-2000 (SWAMP Website 2009) was used to estimate Year 2000 selenium concentrations in particulates and biota (DSM2 data were not available). Years 2004-2005 were used for Year 2005 estimates; and years 2006-2007 were used for Year 2007 estimates.

1 **Table 6D.9 Modeled Annual Average Selenium Concentrations in Water for No Action Alternative and Alternatives 1 (Second Basis of Comparison), 3, and 5**

Location	Period *	Period Average Concentration (µg/L) No Action Alternative	Period Average Concentration (µg/L) Second Basis of Comparison	Period Average Concentration (µg/L) Alternative 3	Period Average Concentration (µg/L) Alternative 5
Delta Interior					
San Joaquin River at Stockton	ALL	0.42	0.42	0.42	0.42
	DROUGHT	0.40	0.40	0.39	0.39
Turner Cut	ALL	0.28	0.27	0.27	0.29
	DROUGHT	0.22	0.21	0.21	0.24
San Joaquin River at San Andreas Landing	ALL	0.11	0.10	0.10	0.11
	DROUGHT	0.10	0.09	0.09	0.10
San Joaquin River at Jersey Point	ALL	0.12	0.11	0.11	0.12
	DROUGHT	0.10	0.10	0.10	0.10
Victoria Canal	ALL	0.23	0.22	0.21	0.24
	DROUGHT	0.17	0.16	0.16	0.21
Western Delta					
Sacramento River at Emmaton	ALL	0.10	0.10	0.10	0.11
	DROUGHT	0.10	0.10	0.10	0.10
San Joaquin River at Antioch	ALL	0.11	0.11	0.11	0.12
	DROUGHT	0.10	0.10	0.10	0.10
Montezuma Slough at Hunter Cut/Beldon's Landing	ALL	0.11	0.11	0.11	0.11
	DROUGHT	0.10	0.10	0.10	0.10
Major Diversions (Pumping Stations)					
North Bay Aqueduct at Barker Slough Pumping Plant	ALL	0.11	0.11	0.11	0.11
	DROUGHT	0.10	0.10	0.10	0.10
Contra Costa Pumping Plant #1	ALL	0.14	0.13	0.13	0.15
	DROUGHT	0.11	0.10	0.10	0.13
Banks Pumping Plant	ALL	0.21	0.19	0.19	0.22
	DROUGHT	0.16	0.14	0.15	0.18
Jones Pumping Plant	ALL	0.28	0.25	0.27	0.29
	DROUGHT	0.26	0.21	0.24	0.26

2 Notes:
 3 * All: Water years 1922-2003 represent the 82-year period modeled using DSM2. Drought: Represents a 5 consecutive year (water years 1987-1991) drought period consisting of dry and critical water year types (as defined by the Sacramento
 4 Valley 40-30-30 water year hydrologic classification index)
 5 µg/L = microgram per liter

1 Table 6D.10 Summary Table for Annual Average Selenium Concentrations in Biota for No Action Alternative and Second Basis of Comparison

Location	Period ^a	Estimated Concentrations of Selenium (mg/kg, dw ^b)							
		Whole-body Fish NAA	Whole-body Fish Alt. 1 (SBC)	Bird Eggs (Invertebrate Diet) NAA	Bird Eggs (Invertebrate Diet) Alt. 1 (SBC)	Bird Eggs (Fish Diet) NAA	Bird Eggs (Fish Diet) Alt. 1 (SBC)	Fish Fillets (ww) NAA	Fish Fillets (ww) Alt. 1 (SBC)
Delta Interior									
San Joaquin River at Stockton	ALL	1.90	1.90	2.83	2.83	3.42	3.42	0.64	0.64
	DROUGHT	2.39	2.39	3.55	3.55	4.30	4.30	0.83	0.83
Turner Cut	ALL	1.88	1.87	2.79	2.79	3.38	3.37	0.63	0.63
	DROUGHT	2.42	2.42	3.59	3.60	4.35	4.35	0.84	0.84
San Joaquin River at San Andreas Landing	ALL	1.82	1.82	2.71	2.71	3.28	3.28	0.61	0.61
	DROUGHT	2.46	2.46	3.65	3.66	4.42	4.42	0.86	0.86
San Joaquin River at Jersey Point	ALL	1.83	1.83	2.72	2.72	3.29	3.29	0.61	0.61
	DROUGHT	2.46	2.46	3.65	3.65	4.42	4.42	0.86	0.86
Victoria Canal	ALL	1.87	1.86	2.78	2.77	3.36	3.35	0.62	0.62
	DROUGHT	2.43	2.43	3.61	3.62	4.37	4.38	0.85	0.85
Western Delta									
Sacramento River at Emmaton	ALL	1.82	1.82	2.71	2.71	3.28	3.28	0.61	0.61
	DROUGHT	2.46	2.46	3.65	3.65	4.42	4.42	0.86	0.86
San Joaquin River at Antioch	ALL	1.83	1.83	2.72	2.72	3.29	3.29	0.61	0.61
	DROUGHT	2.46	2.46	3.65	3.65	4.42	4.42	0.86	0.86
Montezuma Slough at Hunter Cut/Beldon's Landing	ALL	1.82	1.82	2.71	2.71	3.28	3.28	0.61	0.61
	DROUGHT	2.45	2.45	3.65	3.65	4.42	4.42	0.86	0.86
Major Diversions (Pumping Stations)									
North Bay Aqueduct at Barker Slough Pumping Plant	ALL	1.82	1.82	2.71	2.71	3.28	3.28	0.61	0.61
	DROUGHT	2.45	2.45	3.65	3.65	4.42	4.42	0.86	0.86
Contra Costa Pumping Plant #1	ALL	1.84	1.83	2.74	2.73	3.31	3.30	0.61	0.61
	DROUGHT	2.45	2.45	3.64	3.65	4.41	4.42	0.85	0.86
Banks Pumping Plant	ALL	1.86	1.86	2.77	2.76	3.35	3.34	0.62	0.62
	DROUGHT	2.43	2.44	3.62	3.63	4.38	4.39	0.85	0.85

Location	Period ^a	Estimated Concentrations of Selenium (mg/kg, dw ^b)							
		Whole-body Fish NAA	Whole-body Fish Alt. 1 (SBC)	Bird Eggs (Invertebrate Diet) NAA	Bird Eggs (Invertebrate Diet) Alt. 1 (SBC)	Bird Eggs (Fish Diet) NAA	Bird Eggs (Fish Diet) Alt. 1 (SBC)	Fish Fillets (ww) NAA	Fish Fillets (ww) Alt. 1 (SBC)
Jones Pumping Plant	ALL	1.88	1.87	2.79	2.78	3.38	3.37	0.63	0.63
	DROUGHT	2.41	2.42	3.58	3.60	4.33	4.35	0.84	0.84

- 1 Notes:
- 2 a. All: Water years 1922-2003 represent the 82-year period modeled using DSM2. Drought: Represents a 5 consecutive year (water years 1987-1991) drought period consisting of dry and critical water year types (as defined by the Sacramento
- 3 Valley 40-30-30 water year hydrologic classification index)
- 4 b. Dry weight, except as noted for fish fillets
- 5 Alt. = alternative
- 6 dw = dry weight
- 7 mg/kg = milligram per kilogram
- 8 NAA = No Action Alternative
- 9 SBC = Second Basis of Comparison
- 10 "Alt. 1 (SBC)" is the same as Second Basis of Comparison. This nomenclature was used in this appendix to be consistent with the model run output for the model run that represents both Second Basis of Comparison and Alternative 1.
- 11 Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 4 results are not presented separately. Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2
- 12 results are not presented separately.
- 13 ww = wet weight

1 Table 6D.11 Summary Table for Annual Average Selenium Concentrations in Biota for No Action Alternative, Second Basis of Comparison, and Alternative 3

Location	Period ^a	Estimated Concentrations of Selenium (mg/kg, dw ^b)											
		Whole-body Fish NAA	Whole-body Fish Alt. 1 (SBC)	Whole-body Fish Alt. 3	Bird Eggs (Invertebrate Diet) NAA	Bird Eggs (Invertebrate Diet) Alt. 1 (SBC)	Bird Eggs (Invertebrate Diet) Alt. 3	Bird Eggs (Fish Diet) NAA	Bird Eggs (Fish Diet) Alt. 1 (SBC)	Bird Eggs (Fish Diet) Alt. 3	Fish Fillets (ww) NAA	Fish Fillets (ww) Alt. 1 (SBC)	Fish Fillets (ww) Alt. 3
Delta Interior													
San Joaquin River at Stockton	ALL	1.90	1.90	1.90	2.83	2.83	2.83	3.42	3.42	3.42	0.64	0.64	0.64
	DROUGHT	2.39	2.39	2.39	3.55	3.55	3.55	4.30	4.30	4.30	0.83	0.83	0.83
Turner Cut	ALL	1.88	1.87	1.87	2.79	2.79	2.79	3.38	3.37	3.37	0.63	0.63	0.63
	DROUGHT	2.42	2.42	2.42	3.59	3.60	3.60	4.35	4.35	4.35	0.84	0.84	0.84
San Joaquin River at San Andreas Landing	ALL	1.82	1.82	1.82	2.71	2.71	2.71	3.28	3.28	3.28	0.61	0.61	0.61
	DROUGHT	2.46	2.46	2.46	3.65	3.66	3.66	4.42	4.42	4.42	0.86	0.86	0.86
San Joaquin River at Jersey Point	ALL	1.83	1.83	1.82	2.72	2.72	2.77	3.29	3.29	3.35	0.61	0.61	0.62
	DROUGHT	2.46	2.46	2.46	3.65	3.65	3.62	4.42	4.42	4.38	0.86	0.86	0.85
Victoria Canal	ALL	1.87	1.86	1.86	2.78	2.77	2.77	3.36	3.35	3.35	0.62	0.62	0.62
	DROUGHT	2.43	2.43	2.43	3.61	3.62	3.62	4.37	4.38	4.38	0.85	0.85	0.85
Western Delta													
Sacramento River at Emmaton	ALL	1.82	1.82	1.82	2.71	2.71	2.71	3.28	3.28	3.28	0.61	0.61	0.61
	DROUGHT	2.46	2.46	2.46	3.65	3.65	3.65	4.42	4.42	4.42	0.86	0.86	0.86
San Joaquin River at Antioch	ALL	1.83	1.83	1.82	2.72	2.72	2.71	3.29	3.29	3.28	0.61	0.61	0.61
	DROUGHT	2.46	2.46	2.46	3.65	3.65	3.65	4.42	4.42	4.42	0.86	0.86	0.86
Montezuma Slough at Hunter Cut/Beldon's Landing	ALL	1.82	1.82	1.82	2.71	2.71	2.71	3.28	3.28	3.28	0.61	0.61	0.61
	DROUGHT	2.45	2.45	2.46	3.65	3.65	3.65	4.42	4.42	4.42	0.86	0.86	0.86
Major Diversions (Pumping Stations)													
North Bay Aqueduct at Barker Slough Pumping Plant	ALL	1.82	1.82	1.82	2.71	2.71	2.71	3.28	3.28	3.28	0.61	0.61	0.61
	DROUGHT	2.45	2.45	2.45	3.65	3.65	3.65	4.42	4.42	4.42	0.86	0.86	0.86
Contra Costa Pumping Plant #1	ALL	1.84	1.83	1.83	2.74	2.73	2.72	3.31	3.30	3.30	0.61	0.61	0.61
	DROUGHT	2.45	2.45	2.45	3.64	3.65	3.65	4.41	4.42	4.41	0.85	0.86	0.86

Location	Period ^a	Estimated Concentrations of Selenium (mg/kg, dw ^b)											
		Whole-body Fish NAA	Whole-body Fish Alt. 1 (SBC)	Whole-body Fish Alt. 3	Bird Eggs (Invertebrate Diet) NAA	Bird Eggs (Invertebrate Diet) Alt. 1 (SBC)	Bird Eggs (Invertebrate Diet) Alt. 3	Bird Eggs (Fish Diet) NAA	Bird Eggs (Fish Diet) Alt. 1 (SBC)	Bird Eggs (Fish Diet) Alt. 3	Fish Fillets (ww) NAA	Fish Fillets (ww) Alt. 1 (SBC)	Fish Fillets (ww) Alt. 3
Banks Pumping Plant	ALL	1.86	1.86	1.86	2.77	2.76	2.76	3.35	3.34	3.34	0.62	0.62	0.62
	DROUGHT	2.43	2.44	2.44	3.62	3.63	3.62	4.38	4.39	4.39	0.85	0.85	0.85
Jones Pumping Plant	ALL	1.88	1.87	1.87	2.79	2.78	2.79	3.38	3.37	3.37	0.63	0.63	0.63
	DROUGHT	2.41	2.42	2.41	3.58	3.60	3.59	4.33	4.35	4.34	0.84	0.84	0.84

- 1 Notes:
- 2 a. All: Water years 1922-2003 represent the 82-year period modeled using DSM2. Drought: Represents a 5 consecutive year (water years 1987-1991) drought period consisting of dry and critical water year types (as defined by the Sacramento
- 3 Valley 40-30-30 water year hydrologic classification index)
- 4 b. Dry weight, except as noted for fish fillets
- 5 Alt. = alternative
- 6 dw = dry weight
- 7 mg/kg = milligram per kilogram
- 8 NAA = No Action Alternative
- 9 SBC = Second Basis of Comparison
- 10 "Alt. 1 (SBC)" is the same as Second Basis of Comparison. This nomenclature was used in this appendix to be consistent with the model run output for the model run that represents both Second Basis of Comparison and Alternative 1.
- 11 ww = wet weight

1 Table 6D.12 Summary Table for Annual Average Selenium Concentrations in Biota for No Action Alternative, Second Basis of Comparison, and Alternative 5

Location	Period ^a	Estimated Concentrations of Selenium (mg/kg, dw ^b)											
		Whole-body Fish NAA	Whole-body Fish Alt. 1 (SBC)	Whole-body Fish Alt. 5	Bird Eggs (Invertebrate Diet) NAA	Bird Eggs (Invertebrate Diet) Alt. 1 (SBC)	Bird Eggs (Invertebrate Diet) Alt. 5	Bird Eggs (Fish Diet) NAA	Bird Eggs (Fish Diet) Alt. 1 (SBC)	Bird Eggs (Fish Diet) Alt. 5	Fish Fillets (ww) NAA	Fish Fillets (ww) Alt. 1 (SBC)	Fish Fillets (ww) Alt. 5
Delta Interior													
San Joaquin River at Stockton	ALL	1.90	1.90	1.90	2.83	2.83	2.83	3.42	3.42	3.42	0.64	0.64	0.64
	DROUGHT	2.39	2.39	2.39	3.55	3.55	3.55	4.30	4.30	4.30	0.83	0.83	0.83
Turner Cut	ALL	1.88	1.87	1.88	2.79	2.79	2.79	3.38	3.37	3.38	0.63	0.63	0.63
	DROUGHT	2.42	2.42	2.41	3.59	3.60	3.59	4.35	4.35	4.34	0.84	0.84	0.84
San Joaquin River at San Andreas Landing	ALL	1.82	1.82	1.82	2.71	2.71	2.71	3.28	3.28	3.28	0.61	0.61	0.61
	DROUGHT	2.46	2.46	2.45	3.65	3.66	3.65	4.42	4.42	4.42	0.86	0.86	0.86
San Joaquin River at Jersey Point	ALL	1.83	1.83	1.83	2.72	2.72	2.78	3.29	3.29	3.36	0.61	0.61	0.62
	DROUGHT	2.46	2.46	2.45	3.65	3.65	3.60	4.42	4.42	4.35	0.86	0.86	0.84
Victoria Canal	ALL	1.87	1.86	1.87	2.78	2.77	2.78	3.36	3.35	3.36	0.62	0.62	0.62
	DROUGHT	2.43	2.43	2.42	3.61	3.62	3.60	4.37	4.38	4.35	0.85	0.85	0.84
Western Delta													
Sacramento River at Emmaton	ALL	1.82	1.82	1.82	2.71	2.71	2.71	3.28	3.28	3.28	0.61	0.61	0.61
	DROUGHT	2.46	2.46	2.45	3.65	3.65	3.65	4.42	4.42	4.42	0.86	0.86	0.86
San Joaquin River at Antioch	ALL	1.83	1.83	1.83	2.72	2.72	2.72	3.29	3.29	3.29	0.61	0.61	0.61
	DROUGHT	2.46	2.46	2.45	3.65	3.65	3.65	4.42	4.42	4.42	0.86	0.86	0.86
Montezuma Slough at Hunter Cut/Beldon's Landing	ALL	1.82	1.82	1.82	2.71	2.71	2.71	3.28	3.28	3.28	0.61	0.61	0.61
	DROUGHT	2.45	2.45	2.45	3.65	3.65	3.65	4.42	4.42	4.42	0.86	0.86	0.86
Major Diversions (Pumping Stations)													
North Bay Aqueduct at Barker Slough Pumping Plant	ALL	1.82	1.82	1.82	2.71	2.71	2.71	3.28	3.28	3.28	0.61	0.61	0.61
	DROUGHT	2.45	2.45	2.45	3.65	3.65	3.65	4.42	4.42	4.42	0.86	0.86	0.86
Contra Costa Pumping Plant #1	ALL	1.84	1.83	1.84	2.74	2.73	2.74	3.31	3.30	3.32	0.61	0.61	0.61
	DROUGHT	2.45	2.45	2.44	3.64	3.65	3.63	4.41	4.42	4.39	0.85	0.86	0.85
Banks Pumping Plant	ALL	1.86	1.86	1.86	2.77	2.76	2.77	3.35	3.34	3.35	0.62	0.62	0.62
	DROUGHT	2.43	2.44	2.43	3.62	3.63	3.61	4.38	4.39	4.37	0.85	0.85	0.85

Location	Period ^a	Estimated Concentrations of Selenium (mg/kg, dw ^b)											
		Whole-body Fish NAA	Whole-body Fish Alt. 1 (SBC)	Whole-body Fish Alt. 5	Bird Eggs (Invertebrate Diet) NAA	Bird Eggs (Invertebrate Diet) Alt. 1 (SBC)	Bird Eggs (Invertebrate Diet) Alt. 5	Bird Eggs (Fish Diet) NAA	Bird Eggs (Fish Diet) Alt. 1 (SBC)	Bird Eggs (Fish Diet) Alt. 5	Fish Fillets (ww) NAA	Fish Fillets (ww) Alt. 1 (SBC)	Fish Fillets (ww) Alt. 5
Jones Pumping Plant	ALL	1.88	1.87	1.88	2.79	2.78	2.79	3.38	3.37	3.38	0.63	0.63	0.63
	DROUGHT	2.41	2.42	2.41	3.58	3.60	3.58	4.33	4.35	4.33	0.84	0.84	0.84

- 1 Notes:
- 2 a. All: Water years 1922-2003 represent the 82-year period modeled using DSM2. Drought: Represents a 5 consecutive year (water years 1987-1991) drought period consisting of dry and critical water year types (as defined by the Sacramento
- 3 Valley 40-30-30 water year hydrologic classification index)
- 4 b. Dry weight, except as noted for fish fillets
- 5 Alt. = alternative
- 6 dw = dry weight
- 7 mg/kg = milligram per kilogram
- 8 NAA = No Action Alternative
- 9 SBC = Second Basis of Comparison
- 10 "Alt. 1 (SBC)" is the same as Second Basis of Comparison. This nomenclature was used in this appendix to be consistent with the model run output for the model run that represents both Second Basis of Comparison and Alternative 1.
- 11 ww = wet weight

1 Table 6D.13 Summary Table for Selenium Concentrations in Biota, and Comparisons for No Action Alternative and Second Basis of Comparison to Benchmarks

Location	Period ^a	Estimated Concentrations of Selenium (mg/kg, dw ^b)								Exceedance Quotients ^c													
		Whole-body Fish		Bird Eggs (Invertebrate Diet)		Bird Eggs (Fish Diet)		Fish Fillets (ww)		Whole-body Fish				Bird Eggs (Invertebrate Diet)				Bird Eggs (Fish Diet)				Fish Fillets (ww)	
		Level of Concern ^d	Toxicity Level ^e	Level of Concern ^f	Toxicity Level ^g	Level of Concern ^f	Toxicity Level ^g	Level of Concern ^f	Toxicity Level ^g	Level of Concern ^f	Toxicity Level ^g	Level of Concern ^f	Toxicity Level ^g	Level of Concern ^f	Toxicity Level ^g	Level of Concern ^f	Toxicity Level ^g	Level of Concern ^f	Toxicity Level ^g	Level of Concern ^f	Toxicity Level ^g	Advisory Tissue Level ^h	
NAA	Alt. 1 (SBC)	NAA	Alt. 1 (SBC)	NAA	Alt. 1 (SBC)	NAA	Alt. 1 (SBC)	NAA	Alt. 1 (SBC)	NAA	Alt. 1 (SBC)	NAA	Alt. 1 (SBC)	NAA	Alt. 1 (SBC)	NAA	Alt. 1 (SBC)	NAA	Alt. 1 (SBC)	NAA	Alt. 1 (SBC)	NAA	Alt. 1 (SBC)
Delta Interior																							
San Joaquin River at Stockton	ALL	1.90	1.90	2.83	2.83	3.42	3.42	0.64	0.64	0.47	0.47	0.23	0.23	0.47	0.47	0.28	0.28	0.57	0.57	0.34	0.34	0.25	0.25
	DROUGHT	2.39	2.39	3.55	3.55	4.30	4.30	0.83	0.83	0.60	0.60	0.29	0.29	0.59	0.59	0.36	0.36	0.72	0.72	0.43	0.43	0.33	0.33
Turner Cut	ALL	1.88	1.87	2.79	2.79	3.38	3.37	0.63	0.63	0.47	0.47	0.23	0.23	0.47	0.46	0.28	0.28	0.56	0.56	0.34	0.34	0.25	0.25
	DROUGHT	2.42	2.42	3.59	3.60	4.35	4.35	0.84	0.84	0.60	0.60	0.30	0.30	0.60	0.60	0.36	0.36	0.72	0.73	0.43	0.44	0.34	0.34
San Joaquin River at San Andreas Landing	ALL	1.82	1.82	2.71	2.71	3.28	3.28	0.61	0.61	0.46	0.46	0.23	0.22	0.45	0.45	0.27	0.27	0.55	0.55	0.33	0.33	0.24	0.24
	DROUGHT	2.46	2.46	3.65	3.66	4.42	4.42	0.86	0.86	0.61	0.61	0.30	0.30	0.61	0.61	0.37	0.37	0.74	0.74	0.44	0.44	0.34	0.34
San Joaquin River at Jersey Point	ALL	1.83	1.83	2.72	2.72	3.29	3.29	0.61	0.61	0.46	0.46	0.23	0.23	0.45	0.45	0.27	0.27	0.55	0.55	0.33	0.33	0.24	0.24
	DROUGHT	2.46	2.46	3.65	3.65	4.42	4.42	0.86	0.86	0.61	0.61	0.30	0.30	0.61	0.61	0.37	0.37	0.74	0.74	0.44	0.44	0.34	0.34
Victoria Canal	ALL	1.87	1.86	2.78	2.77	3.36	3.35	0.62	0.62	0.47	0.47	0.23	0.23	0.46	0.46	0.28	0.28	0.56	0.56	0.34	0.34	0.25	0.25
	DROUGHT	2.43	2.43	3.61	3.62	4.37	4.38	0.85	0.85	0.61	0.61	0.30	0.30	0.60	0.60	0.36	0.36	0.73	0.73	0.44	0.44	0.34	0.34
Western Delta																							
Sacramento River at Emmaton	ALL	1.82	1.82	2.71	2.71	3.28	3.28	0.61	0.61	0.46	0.46	0.22	0.22	0.45	0.45	0.27	0.27	0.55	0.55	0.33	0.33	0.24	0.24
	DROUGHT	2.46	2.46	3.65	3.65	4.42	4.42	0.86	0.86	0.61	0.61	0.30	0.30	0.61	0.61	0.37	0.37	0.74	0.74	0.44	0.44	0.34	0.34
San Joaquin River at Antioch	ALL	1.83	1.83	2.72	2.72	3.29	3.29	0.61	0.61	0.46	0.46	0.23	0.23	0.45	0.45	0.27	0.27	0.55	0.55	0.33	0.33	0.24	0.24
	DROUGHT	2.46	2.46	3.65	3.65	4.42	4.42	0.86	0.86	0.61	0.61	0.30	0.30	0.61	0.61	0.37	0.37	0.74	0.74	0.44	0.44	0.34	0.34
Montezuma Slough at Hunter Cut/Beldon's Landing	ALL	1.82	1.82	2.71	2.71	3.28	3.28	0.61	0.61	0.46	0.46	0.23	0.23	0.45	0.45	0.27	0.27	0.55	0.55	0.33	0.33	0.24	0.24
	DROUGHT	2.45	2.45	3.65	3.65	4.42	4.42	0.86	0.86	0.61	0.61	0.30	0.30	0.61	0.61	0.37	0.37	0.74	0.74	0.44	0.44	0.34	0.34
Major Diversions (Pumping Stations)																							
North Bay Aqueduct at Barker Slough Pumping Plant	ALL	1.82	1.82	2.71	2.71	3.28	3.28	0.61	0.61	0.46	0.46	0.23	0.23	0.45	0.45	0.27	0.27	0.55	0.55	0.33	0.33	0.24	0.24
	DROUGHT	2.45	2.45	3.65	3.65	4.42	4.42	0.86	0.86	0.61	0.61	0.30	0.30	0.61	0.61	0.37	0.37	0.74	0.74	0.44	0.44	0.34	0.34
Contra Costa Pumping Plant #1	ALL	1.84	1.83	2.74	2.73	3.31	3.30	0.61	0.61	0.46	0.46	0.23	0.23	0.46	0.45	0.27	0.27	0.55	0.55	0.33	0.33	0.25	0.24
	DROUGHT	2.45	2.45	3.64	3.65	4.41	4.42	0.85	0.86	0.61	0.61	0.30	0.30	0.61	0.61	0.36	0.36	0.73	0.74	0.44	0.44	0.34	0.34
Banks Pumping Plant	ALL	1.86	1.86	2.77	2.76	3.35	3.34	0.62	0.62	0.47	0.46	0.23	0.23	0.46	0.46	0.28	0.28	0.56	0.56	0.33	0.33	0.25	0.25
	DROUGHT	2.43	2.44	3.62	3.63	4.38	4.39	0.85	0.85	0.61	0.61	0.30	0.30	0.60	0.60	0.36	0.36	0.73	0.73	0.44	0.44	0.34	0.34
Jones Pumping Plant	ALL	1.88	1.87	2.79	2.78	3.38	3.37	0.63	0.63	0.47	0.47	0.23	0.23	0.47	0.46	0.28	0.28	0.56	0.56	0.34	0.34	0.25	0.25
	DROUGHT	2.41	2.42	3.58	3.60	4.33	4.35	0.84	0.84	0.60	0.60	0.30	0.30	0.60	0.60	0.36	0.36	0.72	0.73	0.43	0.44	0.34	0.34

2

- 1 Notes:
2 a. All: Water years 1922-2003 represent the 82-year period modeled using DSM2. Drought: Represents a 5 consecutive year (water years 1987-1991) drought period consisting of dry and critical water year types (as defined by the Sacramento
3 Valley 40-30-30 water year hydrologic classification index).
4 b. Dry weight, except as noted for fish fillets.
5 c. Exceedance Quotient = tissue concentration/benchmark
6 d. Level of Concern for fish tissue (lower end of range) = 4 mg/kg dw (Beckon et al. 2008)
7 e. Toxicity Level for fish tissue = 8.1 mg/kg dw (USEPA 2014)
8 f. Level of Concern for bird eggs (lower end of range) = 6 mg/kg dw (Beckon et al. 2008)
9 g. Toxicity Level for bird eggs = 10 mg/kg dw (Beckon et al. 2008)
10 h. Advisory Tissue Level = 2.5 mg/kg ww (OEHHA 2008)
- 11 Alt. = Alternative
12 dw = dry weight
13 mg/kg = milligram per kilogram
14 NAA = No Action Alternative
15 SBC = Second Basis of Comparison
16 "Alt. 1 (SBC)" is the same as Second Basis of Comparison. This nomenclature was used in this appendix to be consistent with the model run output for the model run that represents both Second Basis of Comparison and Alternative 1.
17 Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 4 results are not presented separately. Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2
18 results are not presented separately.
19 ww = wet weight

1 **Table 6D.14 Summary Table for Selenium Concentrations in Biota, and Comparisons for Alternative 3 to No Action Alternative and Second Basis of Comparison Conditions and Benchmarks**

Location	Period ^a	Estimated Concentrations of Selenium (mg/kg, dw ^b)				% Change In Selenium Concentrations Compared to NAA and Alternative 1 (Second Basis of Comparison) ^c								Exceedance Quotients ^d									
		Whole-body Fish	Bird Eggs (Invert. Diet)	Bird Eggs (Fish Diet)	Fish Fillets (ww)	Whole-body Fish		Bird Eggs (Invert. Diet)		Bird Eggs (Fish Diet)		Fish Fillets (ww)		Whole-body Fish		Bird Eggs (Invert. Diet)		Bird Eggs (Fish Diet)		Fish Fillets (ww)			
		Alt. 3	Alt. 3	Alt. 3	Alt. 3	NAA	Alt. 1 (SBC)	NAA	Alt. 1 (SBC)	NAA	Alt. 1 (SBC)	NAA	Alt. 1 (SBC)	LOC ^e	TL ^f	LOC ^g	TL ^h	LOC ^g	TL ^h	ATL ⁱ			
Delta Interior																							
San Joaquin River at Stockton	ALL	1.90	2.83	3.42	0.64	0	0	0	0	0	0	0	0	0	0	0	0.47	0.23	0.47	0.28	0.57	0.34	0.25
	DROUGHT	2.39	3.55	4.30	0.83	0	0	0	0	0	0	0	0	0	0	0	0	0.60	0.29	0.59	0.36	0.72	0.43
Turner Cut	ALL	1.87	2.79	3.37	0.63	0	0	0	0	0	0	0	0	0	0	0	0.47	0.23	0.46	0.28	0.56	0.34	0.25
	DROUGHT	2.42	3.60	4.35	0.84	0	0	0	0	0	0	0	0	0	0	0	0.60	0.30	0.60	0.36	0.73	0.44	0.34
San Joaquin River at San Andreas Landing	ALL	1.82	2.71	3.28	0.61	0	0	0	0	0	0	0	0	0	0	0	0.46	0.22	0.45	0.27	0.55	0.33	0.24
	DROUGHT	2.46	3.66	4.42	0.86	0	0	0	0	0	0	0	0	0	0	0	0.61	0.30	0.61	0.37	0.74	0.44	0.34
San Joaquin River at Jersey Point	ALL	1.82	2.77	3.35	0.62	0	0	2	2	2	2	2	2	2	2	2	0.46	0.23	0.46	0.28	0.56	0.34	0.25
	DROUGHT	2.46	3.62	4.38	0.85	0	0	-1	-1	-1	-1	-1	-1	-1	-1	-1	0.61	0.30	0.60	0.36	0.73	0.44	0.34
Victoria Canal	ALL	1.86	2.77	3.35	0.62	0	0	0	0	0	0	0	0	0	0	0	0.47	0.23	0.46	0.28	0.56	0.34	0.25
	DROUGHT	2.43	3.62	4.38	0.85	0	0	0	0	0	0	0	0	0	0	0	0.61	0.30	0.60	0.36	0.73	0.44	0.34
Western Delta																							
Sacramento River at Emmaton	ALL	1.82	2.71	3.28	0.61	0	0	0	0	0	0	0	0	0	0	0	0.46	0.22	0.45	0.27	0.55	0.33	0.24
	DROUGHT	2.46	3.65	4.42	0.86	0	0	0	0	0	0	0	0	0	0	0	0	0.61	0.30	0.61	0.37	0.74	0.44
San Joaquin River at Antioch	ALL	1.82	2.71	3.28	0.61	0	0	0	0	0	0	0	0	0	0	0	0.46	0.23	0.45	0.27	0.55	0.33	0.24
	DROUGHT	2.46	3.65	4.42	0.86	0	0	0	0	0	0	0	0	0	0	0	0.61	0.30	0.61	0.37	0.74	0.44	0.34
Montezuma Slough at Hunter Cut/Beldon's Landing	ALL	1.82	2.71	3.28	0.61	0	0	0	0	0	0	0	0	0	0	0	0.46	0.23	0.45	0.27	0.55	0.33	0.24
	DROUGHT	2.46	3.65	4.42	0.86	0	0	0	0	0	0	0	0	0	0	0	0.61	0.30	0.61	0.37	0.74	0.44	0.34
Major Diversions (Pumping Stations)																							
North Bay Aqueduct at Barker Slough Pumping Plant	ALL	1.82	2.71	3.28	0.61	0	0	0	0	0	0	0	0	0	0	0	0.46	0.23	0.45	0.27	0.55	0.33	0.24
	DROUGHT	2.45	3.65	4.42	0.86	0	0	0	0	0	0	0	0	0	0	0	0	0.61	0.30	0.61	0.37	0.74	0.44
Contra Costa Pumping Plant #1	ALL	1.83	2.72	3.30	0.61	0	0	0	0	0	0	0	0	0	0	0	0.46	0.23	0.45	0.27	0.55	0.33	0.24
	DROUGHT	2.45	3.65	4.41	0.86	0	0	0	0	0	0	0	0	0	0	0	0.61	0.30	0.61	0.36	0.74	0.44	0.34
Banks Pumping Plant	ALL	1.86	2.76	3.34	0.62	0	0	0	0	0	0	0	0	0	0	0	0.46	0.23	0.46	0.28	0.56	0.33	0.25
	DROUGHT	2.44	3.62	4.39	0.85	0	0	0	0	0	0	0	0	0	0	0	0.61	0.30	0.60	0.36	0.73	0.44	0.34
Jones Pumping Plant	ALL	1.87	2.79	3.37	0.63	0	0	0	0	0	0	0	0	0	0	0	0.47	0.23	0.46	0.28	0.56	0.34	0.25
	DROUGHT	2.41	3.59	4.34	0.84	0	0	0	0	0	0	0	0	0	0	0	0.60	0.30	0.60	0.36	0.72	0.43	0.34

2
3
4 Notes:
5 a. All: Water years 1922-2003 represent the 82-year period modeled using DSM2. Drought: Represents a 5 consecutive year (water years 1987-1991) drought period consisting of dry and critical water year types (as defined by the Sacramento
6 Valley 40-30-30 water year hydrologic classification index).
7 b. Dry weight, except as noted for fish fillets.
8 c. % change indicates a negative change (increased concentrations) relative to the No Action Alternative and Second Basis of Comparison when values are positive and a positive change (lowered concentrations) relative to the No Action
9 Alternative and Second Basis of Comparison when values are negative.
10 d. Exceedance Quotient = tissue concentration/benchmark
11 e. Level of Concern for fish tissue (lower end of range) = 4 mg/kg dw (Beckon et al. 2008)
12 f. Toxicity Level for fish tissue = 8.1 mg/kg dw (USEPA 2014)
13 g. Level of Concern for bird eggs (lower end of range) = 6 mg/kg dw (Beckon et al. 2008)
14 h. Toxicity Level for bird eggs = 10 mg/kg dw (Beckon et al. 2008)
i. Advisory Tissue Level = 2.5 mg/kg ww (OEHHA 2008)

- 1 Notes (continued):
- 2 Alt. = alternative
- 3 dw = dry weight
- 4 Invert. = invertebrate
- 5 mg/kg = milligram per kilogram
- 6 NAA = No Action Alternative
- 7 SBC = Second Basis of Comparison
- 8 "Alt. 1 (SBC)" is the same as Second Basis of Comparison. This nomenclature was used in this appendix to be consistent with the model run output for the model run that represents both Second Basis of Comparison and Alternative 1.
- 9 ww = wet weight

1 **Table 6D.15 Summary Table for Selenium Concentrations in Biota, and Comparisons for Alternative 5 to No Action Alternative and Second Basis of Comparison Conditions and Benchmarks**

Location	Period ^a	Estimated Concentrations of Selenium (mg/kg, dw ^b)				% Change In Selenium Concentrations Compared to NAA and Alternative 1 (Second Basis of Comparison) ^c								Exceedance Quotients ^d							
		Whole-body Fish	Bird Eggs (Invert. Diet)	Bird Eggs (Fish Diet)	Fish Fillets (ww)	Whole-body Fish		Bird Eggs (Invert. Diet)		Bird Eggs (Fish Diet)		Fish Fillets (ww)		Whole-body Fish		Bird Eggs (Invert. Diet)		Bird Eggs (Fish Diet)		Fish Fillets (ww)	
		Alt. 5	Alt. 5	Alt. 5	Alt. 5	NAA	Alt. 1 (SBC)	NAA	Alt. 1 (SBC)	NAA	Alt. 1 (SBC)	NAA	Alt. 1 (SBC)	LOC ^e	TL ^f	LOC ^g	TL ^h	LOC ^g	TL ^h	ATL ⁱ	
Delta Interior																					
San Joaquin River at Stockton	ALL	1.90	2.83	3.42	0.64	0	0	0	0	0	0	0	0	0	0.47	0.23	0.47	0.28	0.57	0.34	0.25
	DROUGHT	2.39	3.55	4.30	0.83	0	0	0	0	0	0	0	0	0	0.60	0.29	0.59	0.36	0.72	0.43	0.33
Turner Cut	ALL	1.88	2.79	3.38	0.63	0	0	0	0	0	0	0	0	0.47	0.23	0.47	0.28	0.56	0.34	0.25	
	DROUGHT	2.41	3.59	4.34	0.84	0	0	0	0	0	0	0	0	0.60	0.30	0.60	0.36	0.72	0.43	0.34	
San Joaquin River at San Andreas Landing	ALL	1.82	2.71	3.28	0.61	0	0	0	0	0	0	0	0	0.46	0.23	0.45	0.27	0.55	0.33	0.24	
	DROUGHT	2.45	3.65	4.42	0.86	0	0	0	0	0	0	0	0	0.61	0.30	0.61	0.37	0.74	0.44	0.34	
San Joaquin River at Jersey Point	ALL	1.83	2.78	3.36	0.62	0	0	2	2	2	2	3	3	0.46	0.23	0.46	0.28	0.56	0.34	0.25	
	DROUGHT	2.45	3.60	4.35	0.84	0	0	-1	-2	-1	-2	-2	-2	0.61	0.30	0.60	0.36	0.73	0.44	0.34	
Victoria Canal	ALL	1.87	2.78	3.36	0.62	0	0	0	0	0	0	0	0	0.47	0.23	0.46	0.28	0.56	0.34	0.25	
	DROUGHT	2.42	3.60	4.35	0.84	0	0	0	0	0	0	0	-1	0.60	0.30	0.60	0.36	0.73	0.44	0.34	
Western Delta																					
Sacramento River at Emmaton	ALL	1.82	2.71	3.28	0.61	0	0	0	0	0	0	0	0	0.46	0.23	0.45	0.27	0.55	0.33	0.24	
	DROUGHT	2.45	3.65	4.42	0.86	0	0	0	0	0	0	0	0	0.61	0.30	0.61	0.37	0.74	0.44	0.34	
San Joaquin River at Antioch	ALL	1.83	2.72	3.29	0.61	0	0	0	0	0	0	0	0	0.46	0.23	0.45	0.27	0.55	0.33	0.24	
	DROUGHT	2.45	3.65	4.42	0.86	0	0	0	0	0	0	0	0	0.61	0.30	0.61	0.37	0.74	0.44	0.34	
Montezuma Slough at Hunter Cut/Beldon's Landing	ALL	1.82	2.71	3.28	0.61	0	0	0	0	0	0	0	0	0.46	0.23	0.45	0.27	0.55	0.33	0.24	
	DROUGHT	2.45	3.65	4.42	0.86	0	0	0	0	0	0	0	0	0.61	0.30	0.61	0.37	0.74	0.44	0.34	
Major Diversions (Pumping Stations)																					
North Bay Aqueduct at Barker Slough Pumping Plant	ALL	1.82	2.71	3.28	0.61	0	0	0	0	0	0	0	0	0.46	0.23	0.45	0.27	0.55	0.33	0.24	
	DROUGHT	2.45	3.65	4.42	0.86	0	0	0	0	0	0	0	0	0.61	0.30	0.61	0.37	0.74	0.44	0.34	
Contra Costa Pumping Plant #1	ALL	1.84	2.74	3.32	0.61	0	1	0	1	0	1	0	1	0.46	0.23	0.46	0.27	0.55	0.33	0.25	
	DROUGHT	2.44	3.63	4.39	0.85	0	-1	0	-1	0	-1	0	-1	0.61	0.30	0.61	0.36	0.73	0.44	0.34	
Banks Pumping Plant	ALL	1.86	2.77	3.35	0.62	0	0	0	0	0	0	0	0	0.47	0.23	0.46	0.28	0.56	0.34	0.25	
	DROUGHT	2.43	3.61	4.37	0.85	0	0	0	0	0	0	0	-1	0.61	0.30	0.60	0.36	0.73	0.44	0.34	
Jones Pumping Plant	ALL	1.88	2.79	3.38	0.63	0	0	0	0	0	0	0	0	0.47	0.23	0.47	0.28	0.56	0.34	0.25	
	DROUGHT	2.41	3.58	4.33	0.84	0	0	0	0	0	0	0	-1	0.60	0.30	0.60	0.36	0.72	0.43	0.34	

2
3
4 Notes:
5 a. All: Water years 1922-2003 represent the 82-year period modeled using DSM2. Drought: Represents a 5 consecutive year (water years 1987-1991) drought period consisting of dry and critical water year types (as defined by the Sacramento
6 Valley 40-30-30 water year hydrologic classification index).
7 b. Dry weight, except as noted for fish fillets.
8 c. % change indicates a negative change (increased concentrations) relative to the No Action Alternative and Second Basis of Comparison when values are positive and a positive change (lowered concentrations) relative to the No Action
9 Alternative and Second Basis of Comparison when values are negative.
10 d. Exceedance Quotient = tissue concentration/benchmark
11 e. Level of Concern for fish tissue (lower end of range) = 4 mg/kg dw (Beckon et al. 2008)
12 f. Toxicity Level for fish tissue = 8.1 mg/kg dw (USEPA 2014)
13 g. Level of Concern for bird eggs (lower end of range) = 6 mg/kg dw (Beckon et al. 2008)
14 h. Toxicity Level for bird eggs = 10 mg/kg dw (Beckon et al. 2008)
i. Advisory Tissue Level = 2.5 mg/kg ww (OEHHA 2008)

- 1 Notes (continued):
- 2 Alt. = alternative
- 3 dw = dry weight
- 4 Invert. = invertebrate
- 5 mg/kg = milligram per kilogram
- 6 NAA = No Action Alternative
- 7 SBC = Second Basis of Comparison
- 8 "Alt. 1 (SBC)" is the same as Second Basis of Comparison. This nomenclature was used in this appendix to be consistent with the model run output for the model run that represents both Second Basis of Comparison and Alternative 1.
- 9 ww = wet weight

1 **Table 6D.16 Modeled Selenium Concentrations in Water for No Action Alternative and Alternatives 1 (Second Basis of Comparison),**
 2 **3, and 5**

Location	Period *	Period Average Concentration (µg/L) No Action Alternative	Period Average Concentration (µg/L) Alternative 1 (SBC)	Period Average Concentration (µg/L) Alternative 3	Period Average Concentration (µg/L) Alternative 5
Sacramento River at Emmaton	ALL	0.10	0.10	0.10	0.11
	DROUGHT	0.10	0.10	0.10	0.10
San Joaquin River at Antioch	ALL	0.11	0.11	0.11	0.12
	DROUGHT	0.10	0.10	0.10	0.10
Montezuma Slough at Hunter Cut/Beldon's Landing	ALL	0.11	0.11	0.11	0.11
	DROUGHT	0.10	0.10	0.10	0.10

3 Notes:

4 * All: Water years 1922-2003 represent the 82-year period modeled using DSM2. Drought: Represents a 5-consecutive-year (Water Years
 5 1987-1991) drought period consisting of dry and critical water-year types (as defined by the Sacramento Valley 40-30-30 water year hydrologic
 6 classification index).

7 "Alt. 1 (SBC)" is the same as Second Basis of Comparison. This nomenclature was used in this appendix to be consistent with the model run
 8 output for the model run that represents both Second Basis of Comparison and Alternative 1.

9 Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 4 results are not presented separately.
 10 Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented separately.

11 µg/L = microgram per liter

12 SBC = Second Basis of Comparison

1 **Table 6D.17 Summary of Annual Average Selenium Concentrations in Whole-body Sturgeon**

Location	Period *	Estimated Concentrations of Selenium in Whole-body Sturgeon (mg/kg, dw) No Action Alternative	Estimated Concentrations of Selenium in Whole-body Sturgeon (mg/kg, dw) Alternative 1 (SBC)	Estimated Concentrations of Selenium in Whole-body Sturgeon (mg/kg, dw) Alternative 3	Estimated Concentrations of Selenium in Whole-body Sturgeon (mg/kg, dw) Alternative 5
Sacramento River at Emmaton	ALL	4.16	4.11	4.08	4.20
	DROUGHT	6.96	6.92	6.91	7.09
San Joaquin River at Antioch	ALL	4.56	4.40	4.34	4.61
	DROUGHT	7.06	6.99	6.97	7.23
Montezuma Slough at Hunter Cut/Beldon's Landing	ALL	4.33	4.27	4.24	4.35
	DROUGHT	7.10	7.07	7.06	7.16

- 2 Notes:
- 3 * All: Water years 1922-2003 represent the 82-year period modeled using DSM2. Drought: Represents a 5-consecutive-year (Water Years
- 4 1987-1991) drought period consisting of dry and critical water-year types (as defined by the Sacramento Valley 40-30-30 water year hydrologic
- 5 classification index).
- 6 "Alt. 1 (SBC)" is the same as Second Basis of Comparison. This nomenclature was used in this appendix to be consistent with the model run
- 7 output for the model run that represents both Second Basis of Comparison and Alternative 1.
- 8 Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 4 results are not presented separately.
- 9 Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented separately.
- 10 dw = dry weight
- 11 mg/kg = milligram per kilogram
- 12 SBC = Second Basis of Comparison

1 **Table 6D.18 Comparison of Annual Average Selenium Concentrations in Whole-body Sturgeon to Toxicity Thresholds^a**

Location	Period ^b	No Action Alternative Low	No Action Alternative High	Second Basis of Comparison Low	Second Basis of Comparison High	Alternative 3 Low	Alternative 3 High	Alternative 5 Low	Alternative 5 High
Sacramento River at Emmaton	ALL	0.83	0.52	0.8	0.51	0.8	0.51	0.8	0.52
	DROUGHT	1.4	0.87	1.4	0.86	1.4	0.86	1.4	0.9
San Joaquin River at Antioch	ALL	0.9	0.57	0.9	0.55	0.9	0.54	0.9	0.6
	DROUGHT	1.4	0.88	1.4	0.87	1.4	0.87	1.4	0.9
Montezuma Slough at Hunter Cut/ Beldon's Landing	ALL	0.87	0.54	0.85	0.53	0.85	0.53	0.9	0.54
	DROUGHT	1.4	0.89	1.4	0.88	1.4	0.88	1.4	0.9

2 Notes:

3 a. Toxicity thresholds are those reported in Presser and Luoma (2013): Low = 5 mg/kg, dw and High = 8 mg/kg, dw

4 b. All: Water years 1922-2003 represent the 82-year period modeled using DSM2. Drought: Represents a 5-consecutive-year (Water Years 1987-
5 1991) drought period consisting of dry and critical water-year types (as defined by the Sacramento Valley 40-30-30 water year hydrologic
6 classification index).7 Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented
8 separately. Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented separately.

9 dw = dry weight

10 mg/kg = milligram per kilogram

11 SBC = Second Basis of Comparison

1 **Table 6D.19 Percent Change in Selenium Concentrations Relative to No Action Alternative and Second Basis of Comparison**

Location	Period *	Alternative 3 NAA	Alternative 3 Alt1 (SBC)	Alternative 5 NAA	Alternative 5 Alt 1 (SBC)
Sacramento River at Emmaton	ALL	-2.0	-0.7	0.9	2.2
	DROUGHT	-0.8	-0.1	1.8	2.5
San Joaquin River at Antioch	ALL	-4.7	-1.3	1.2	4.8
	DROUGHT	-1.2	-0.2	2.5	3.5
Montezuma Slough at Hunter Cut/Beldon's Landing	ALL	-2.2	-0.7	0.5	2.1
	DROUGHT	-0.5	-0.1	0.8	1.2

2 Notes:

3 * All: Water years 1922-2003 represent the 82-year period modeled using DSM2. Drought: Represents a 5-consecutive-year (Water Years 1987-
4 1991) drought period consisting of dry and critical water-year types (as defined by the Sacramento Valley 40-30-30 water year hydrologic
5 classification index).

6 "Alt. 1 (SBC)" is the same as Second Basis of Comparison. This nomenclature was used in this appendix to be consistent with the model run
7 output for the model run that represents both Second Basis of Comparison and Alternative 1.


8 Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 4 results are not presented separately.

9 Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented separately.

10 dw = dry weight

11 mg/kg = milligram per kilogram

12 SBC = Second Basis of Comparison

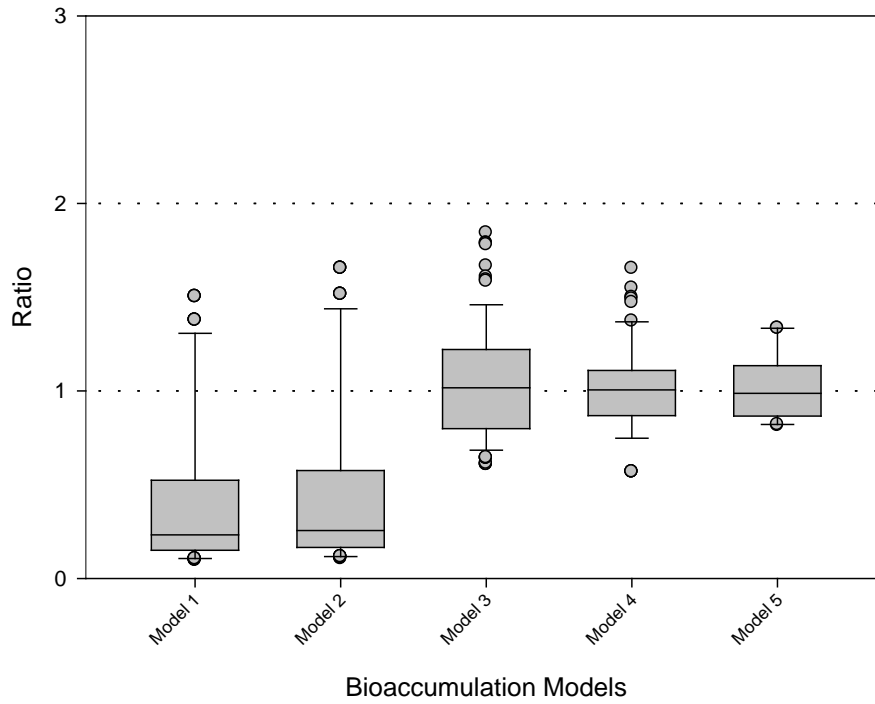

For Models 1 and 2, default values ($K_d = 1000$, $TTF_{invert} = 2.8$, $TTF_{fish} = 1.1$) were used in calculations as follows:

Model 1=Trophic level 3 (TL-3) fish eating invertebrates

Model 2= TL-4 fish eating TL-3 fish


Model 3=Model 2 with K_d estimated using all years regression ($\log K_d = 2.76-0.97(\log DSM2)$)

Model 4=Model 2 with K_d estimated using normal/wet years (2000/2005) regression ($\log K_d = 2.75-0.90(\log DSM2)$)

Model 5=Model 2 with K_d estimated using dry years (2007) regression ($\log K_d = 2.84-1.02(\log DSM2)$)

1


2 **Figure 6D.1 Ratios of Predicted Selenium Concentrations in Fish Models 1 through**
 3 **5 to Observed Selenium Concentrations in Largemouth Bass**

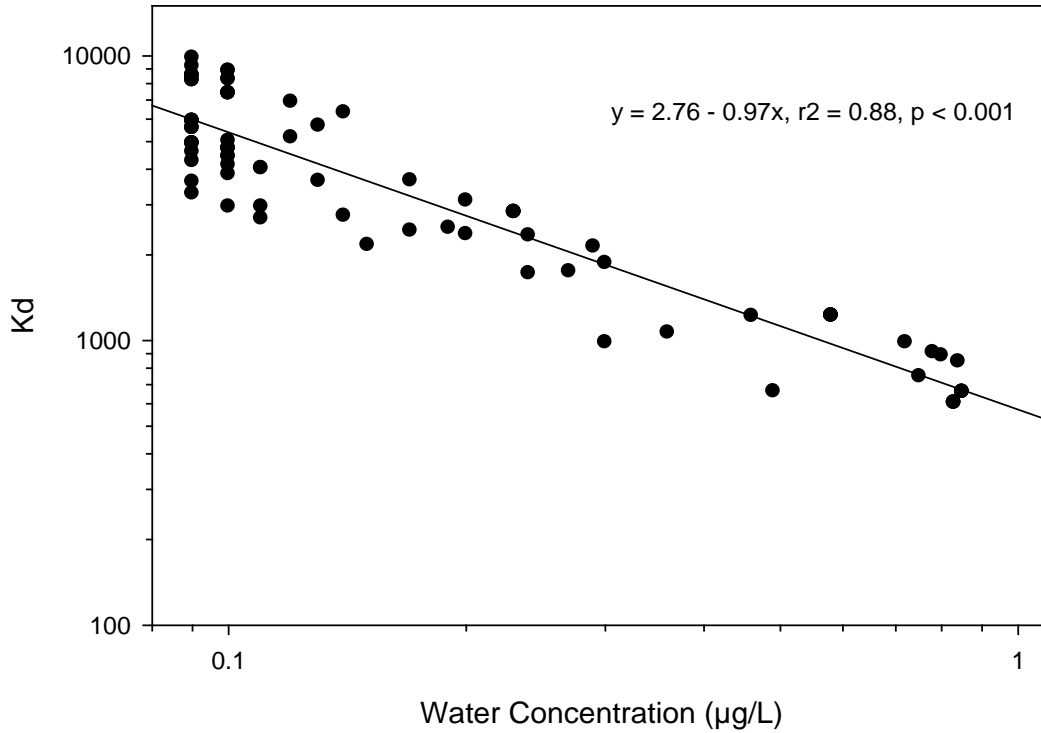

1

2 **Figure 6D.2 Log-log Regression Relation of Estimated K_d to Waterborne Selenium**
3 **Concentration for Model 3 in All Years (Based on Years 2000, 2005, and 2007)**


4 To predict the K_d (y) from water concentrations using the regression equation, take the
5 log of the water concentration (x), multiply it by the slope (-0.97), which gives a positive
6 number for $x < 1$ (i.e., waterborne selenium concentrations less than 1 $\mu\text{g/L}$); then add this
7 number to the intercept (2.76) and take the antilog.

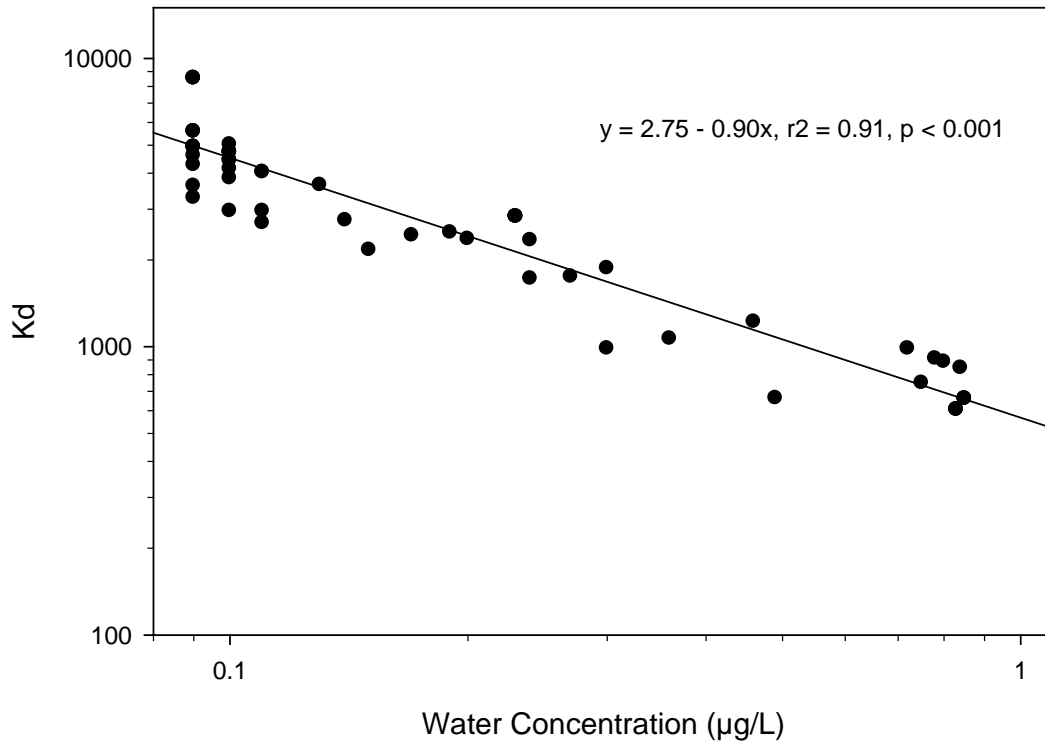

1

2 **Figure 6D.3 Log-log Regression Relation of Estimated K_d to Waterborne Selenium**
 3 **Concentration for Model 4 in Normal/Wet Years (Based on Years 2000 and 2005)**


4 To predict the K_d (y) from water concentrations using the regression equation, take the
 5 log of the water concentration (x), multiply it by the slope (-0.90), which gives a positive
 6 number for $x < 1$ (i.e., waterborne selenium concentrations less than 1 $\mu\text{g/L}$); then add this
 7 number to the intercept (2.75) and take the antilog.

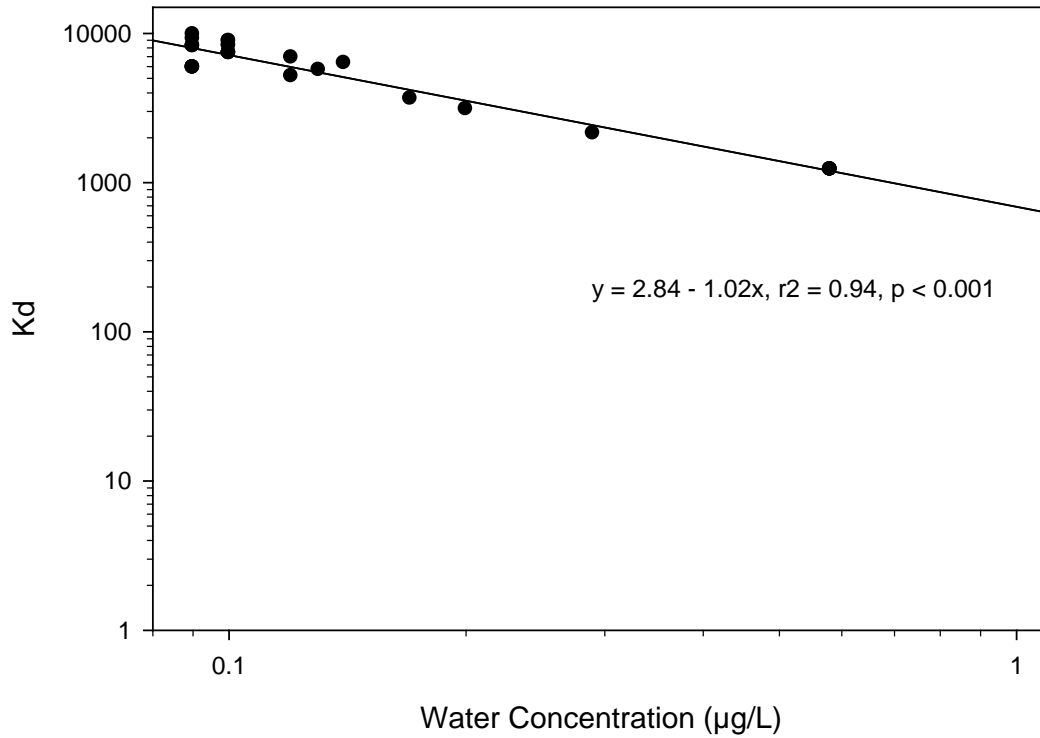

1


2 **Figure 6D.4 Log-log Regression Relation of Estimated K_d to Waterborne Selenium**
3 **Concentration for Model 5 in Dry Years (Based on Year 2007)**

4 To predict the K_d (y) from water concentrations using the regression equation, take the
5 log of the water concentration (x), multiply it by the slope (-1.02), which gives a positive
6 number for $x < 1$ (i.e., waterborne selenium concentrations less than 1 $\mu\text{g/L}$); then add this
7 number to the intercept (2.84) and take the antilog.

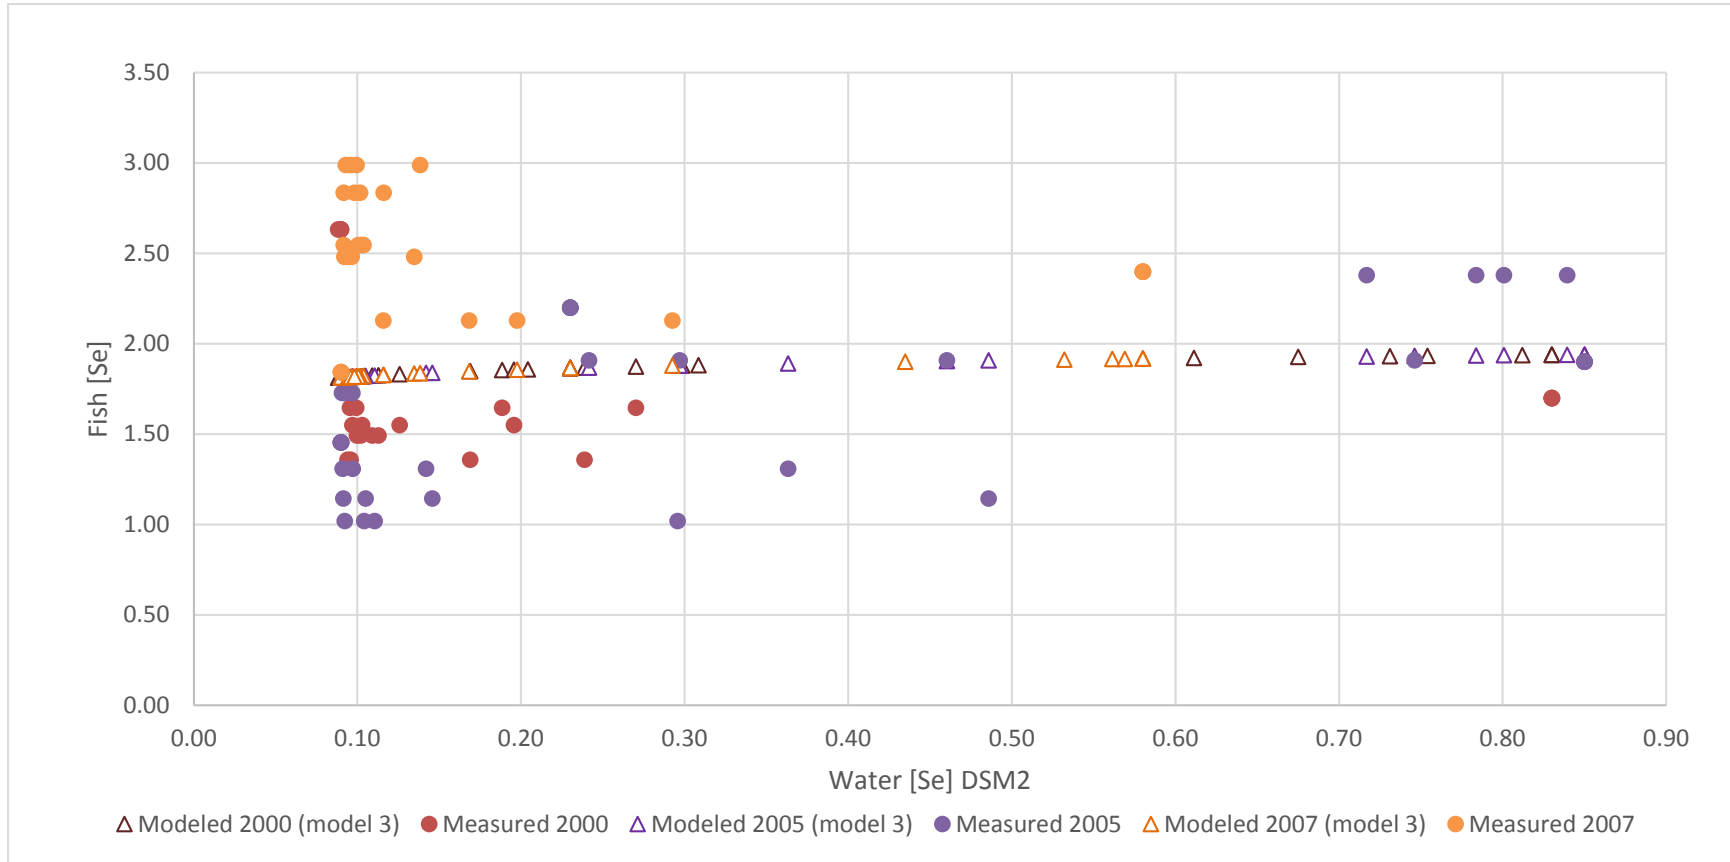


1
2 **Figure 6D.5 Distribution of Data for Selenium Concentrations in Largemouth Bass Relative to Waterborne Selenium for Model 3**

Appendix 6D: Selenium Model Documentation

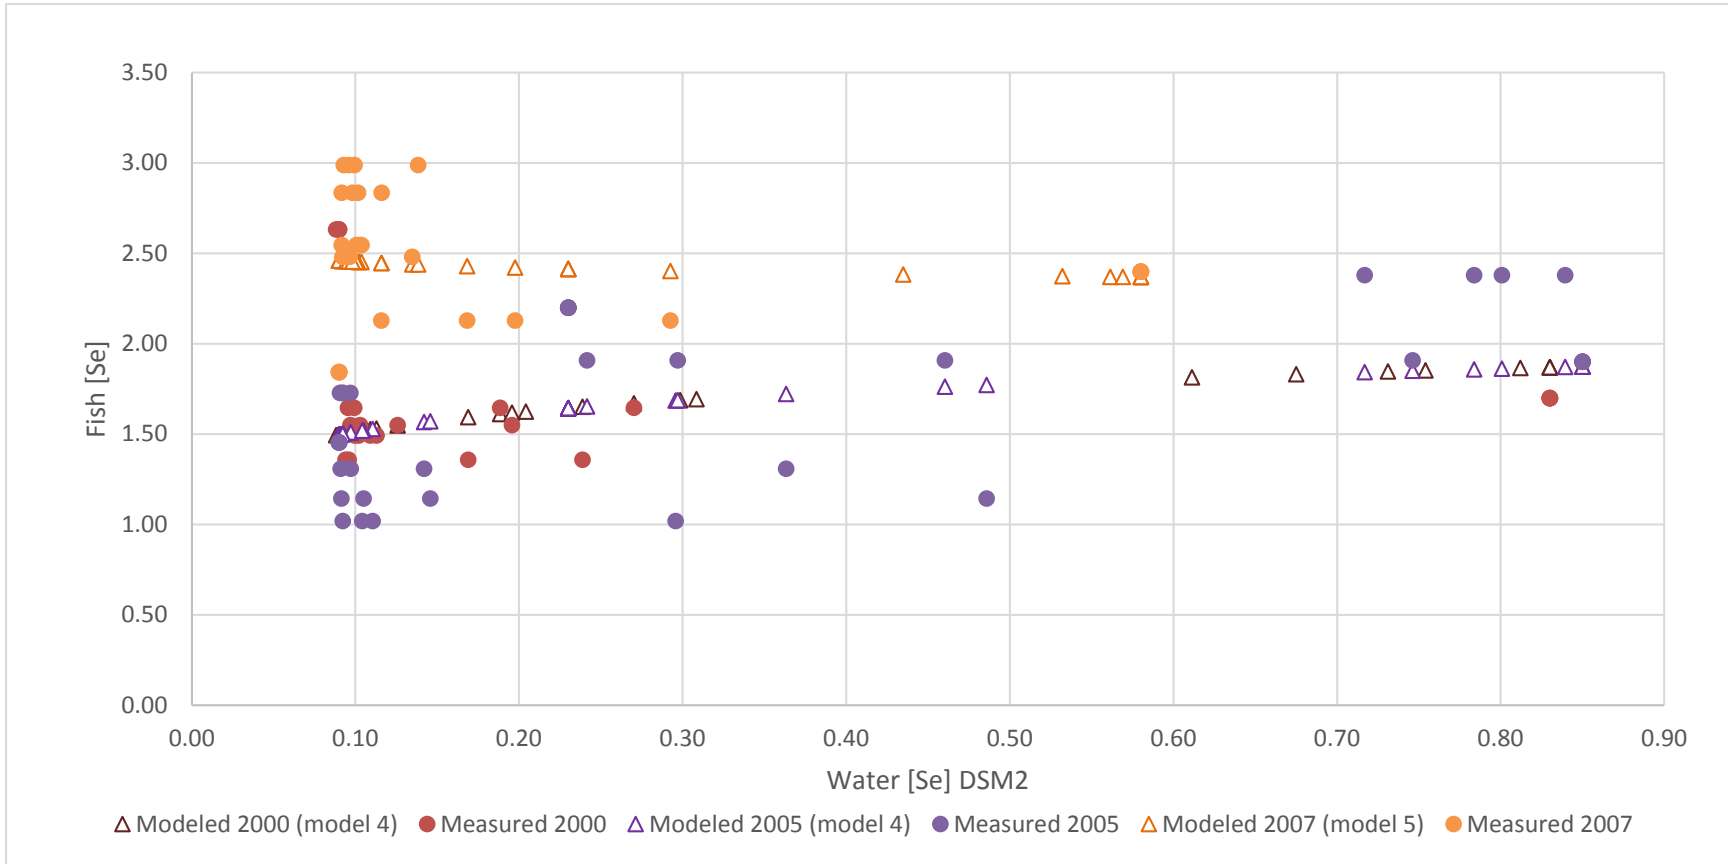


1
2
3

Figure 6D.6 Distribution of Data for Selenium Concentrations in Largemouth Bass Relative to Waterborne Selenium for Model 4 and Model 5

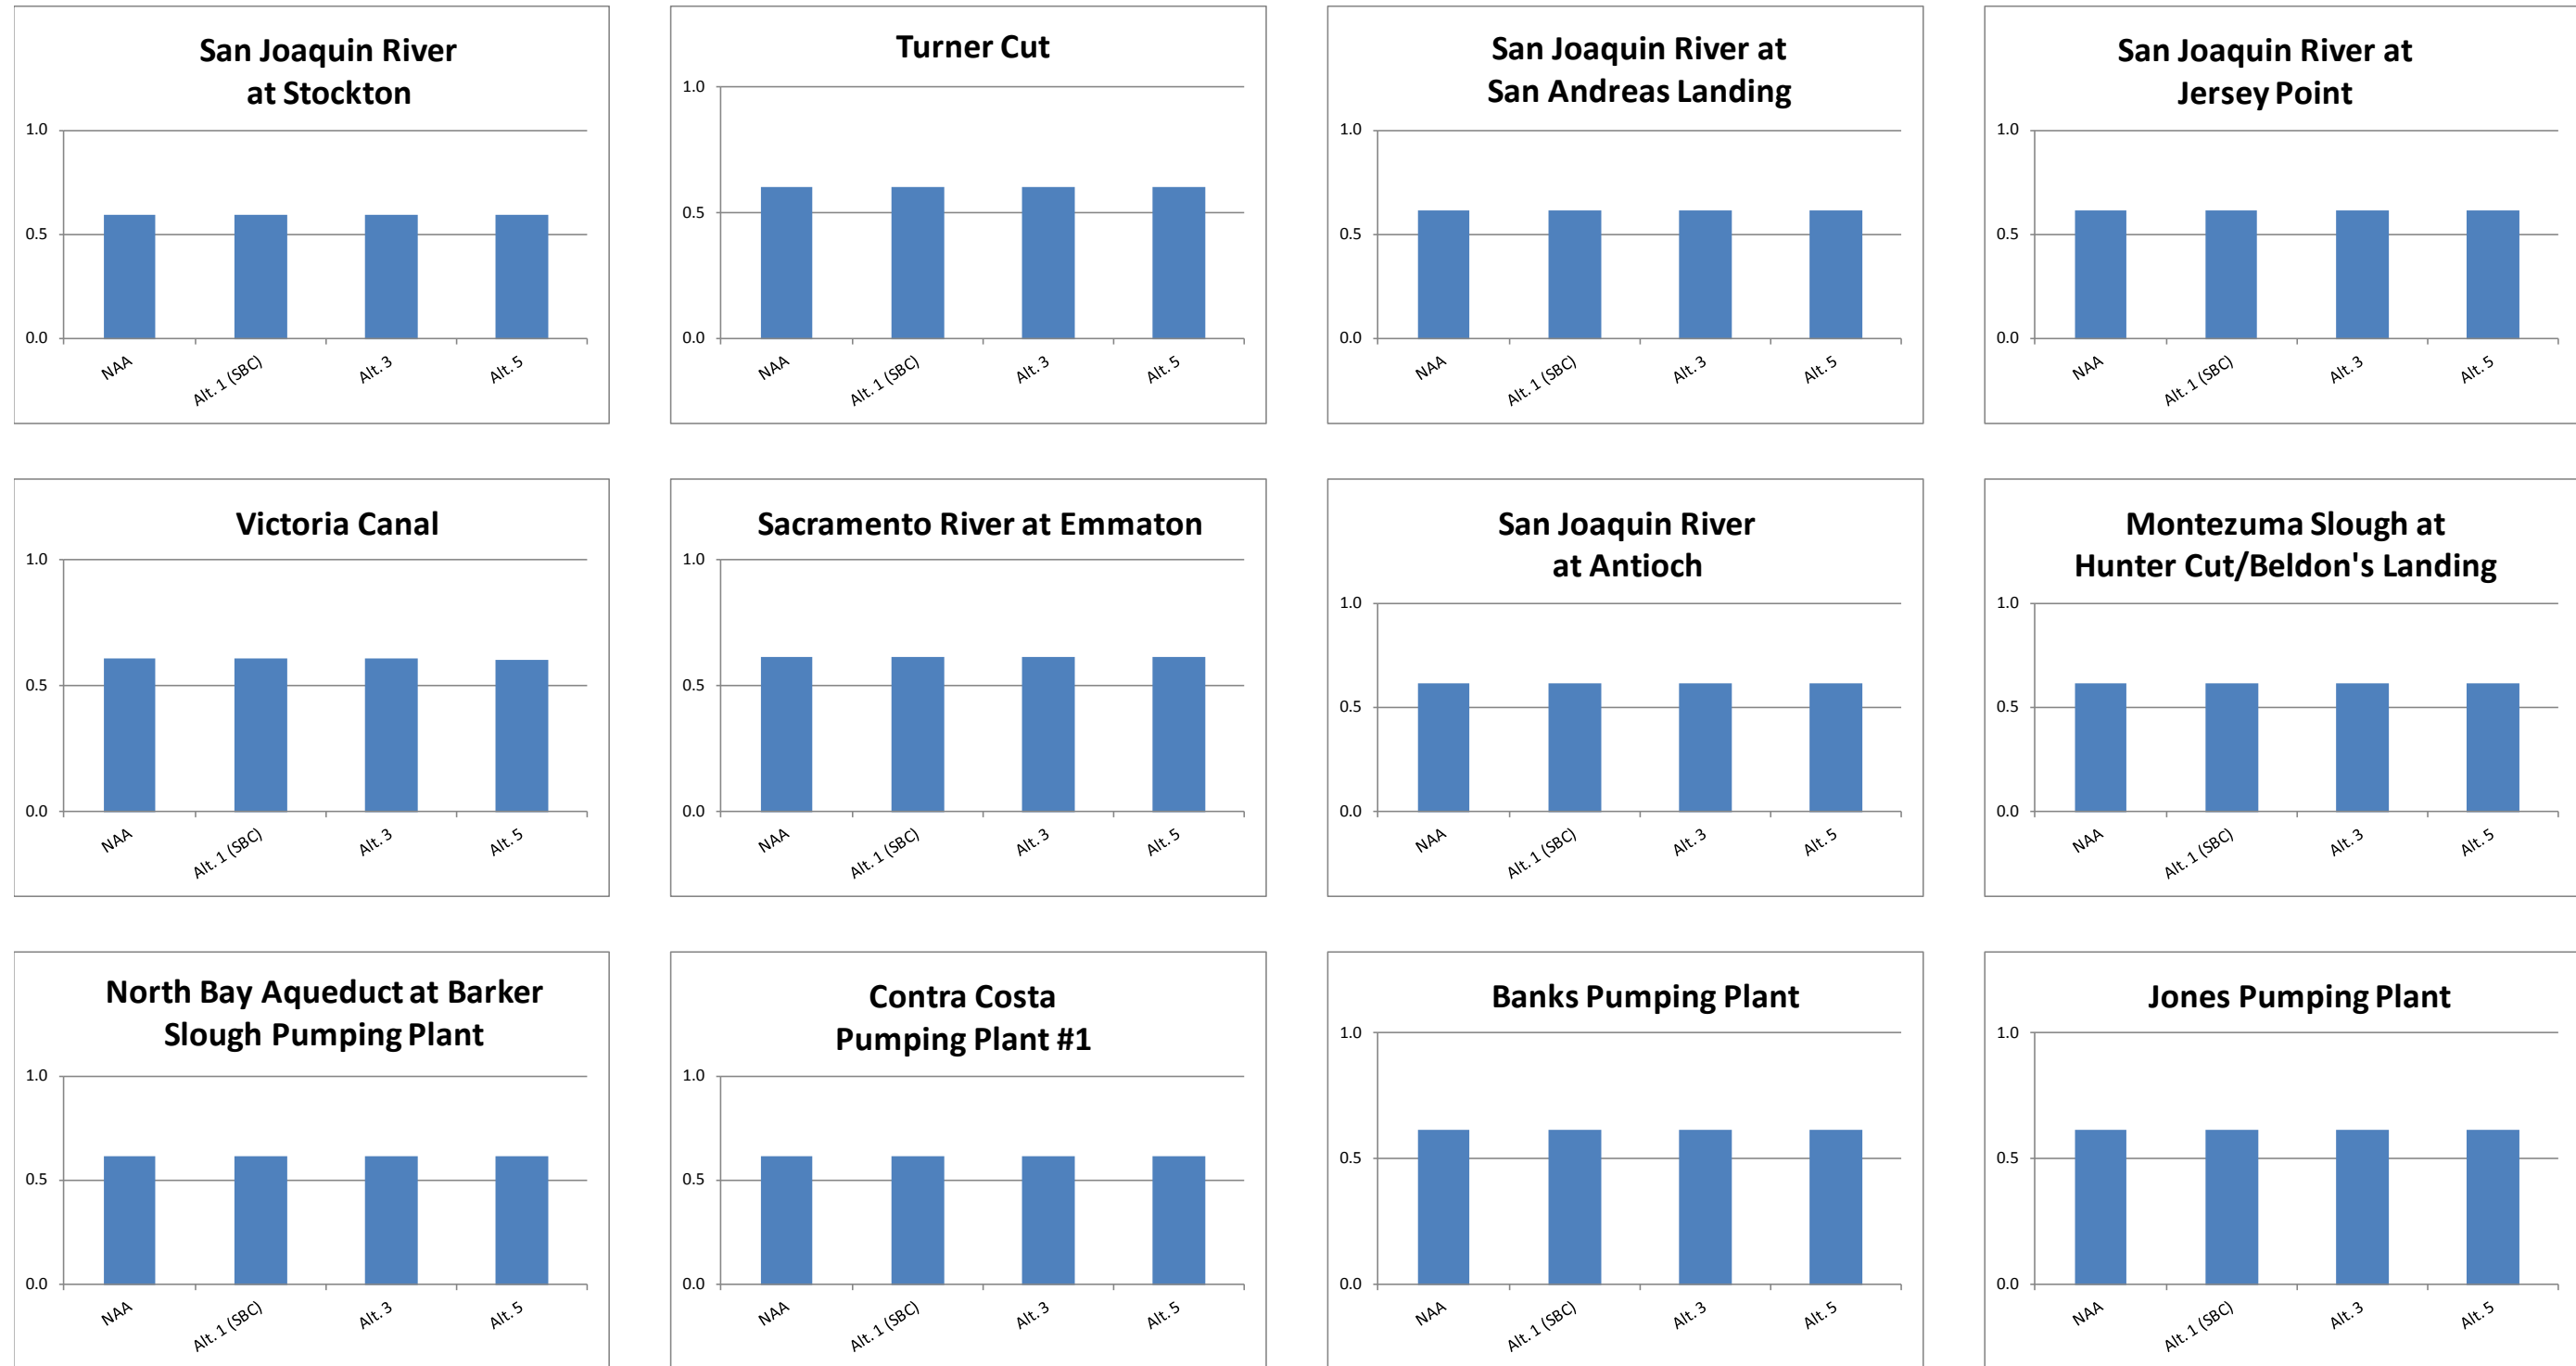


1
2 **Figure 6D.7 Level of Concern Exceedance Quotients for Selenium Concentrations in Whole-Body Fish for Drought Years**

3 "Alt. 1 (SBC)" is the same as Second Basis of Comparison. This nomenclature was used in this appendix to be consistent with the model run output for the model run that represents both Second Basis of Comparison and Alternative 1.
4 Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 4 results are not presented separately. Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2
5 results are not presented separately.

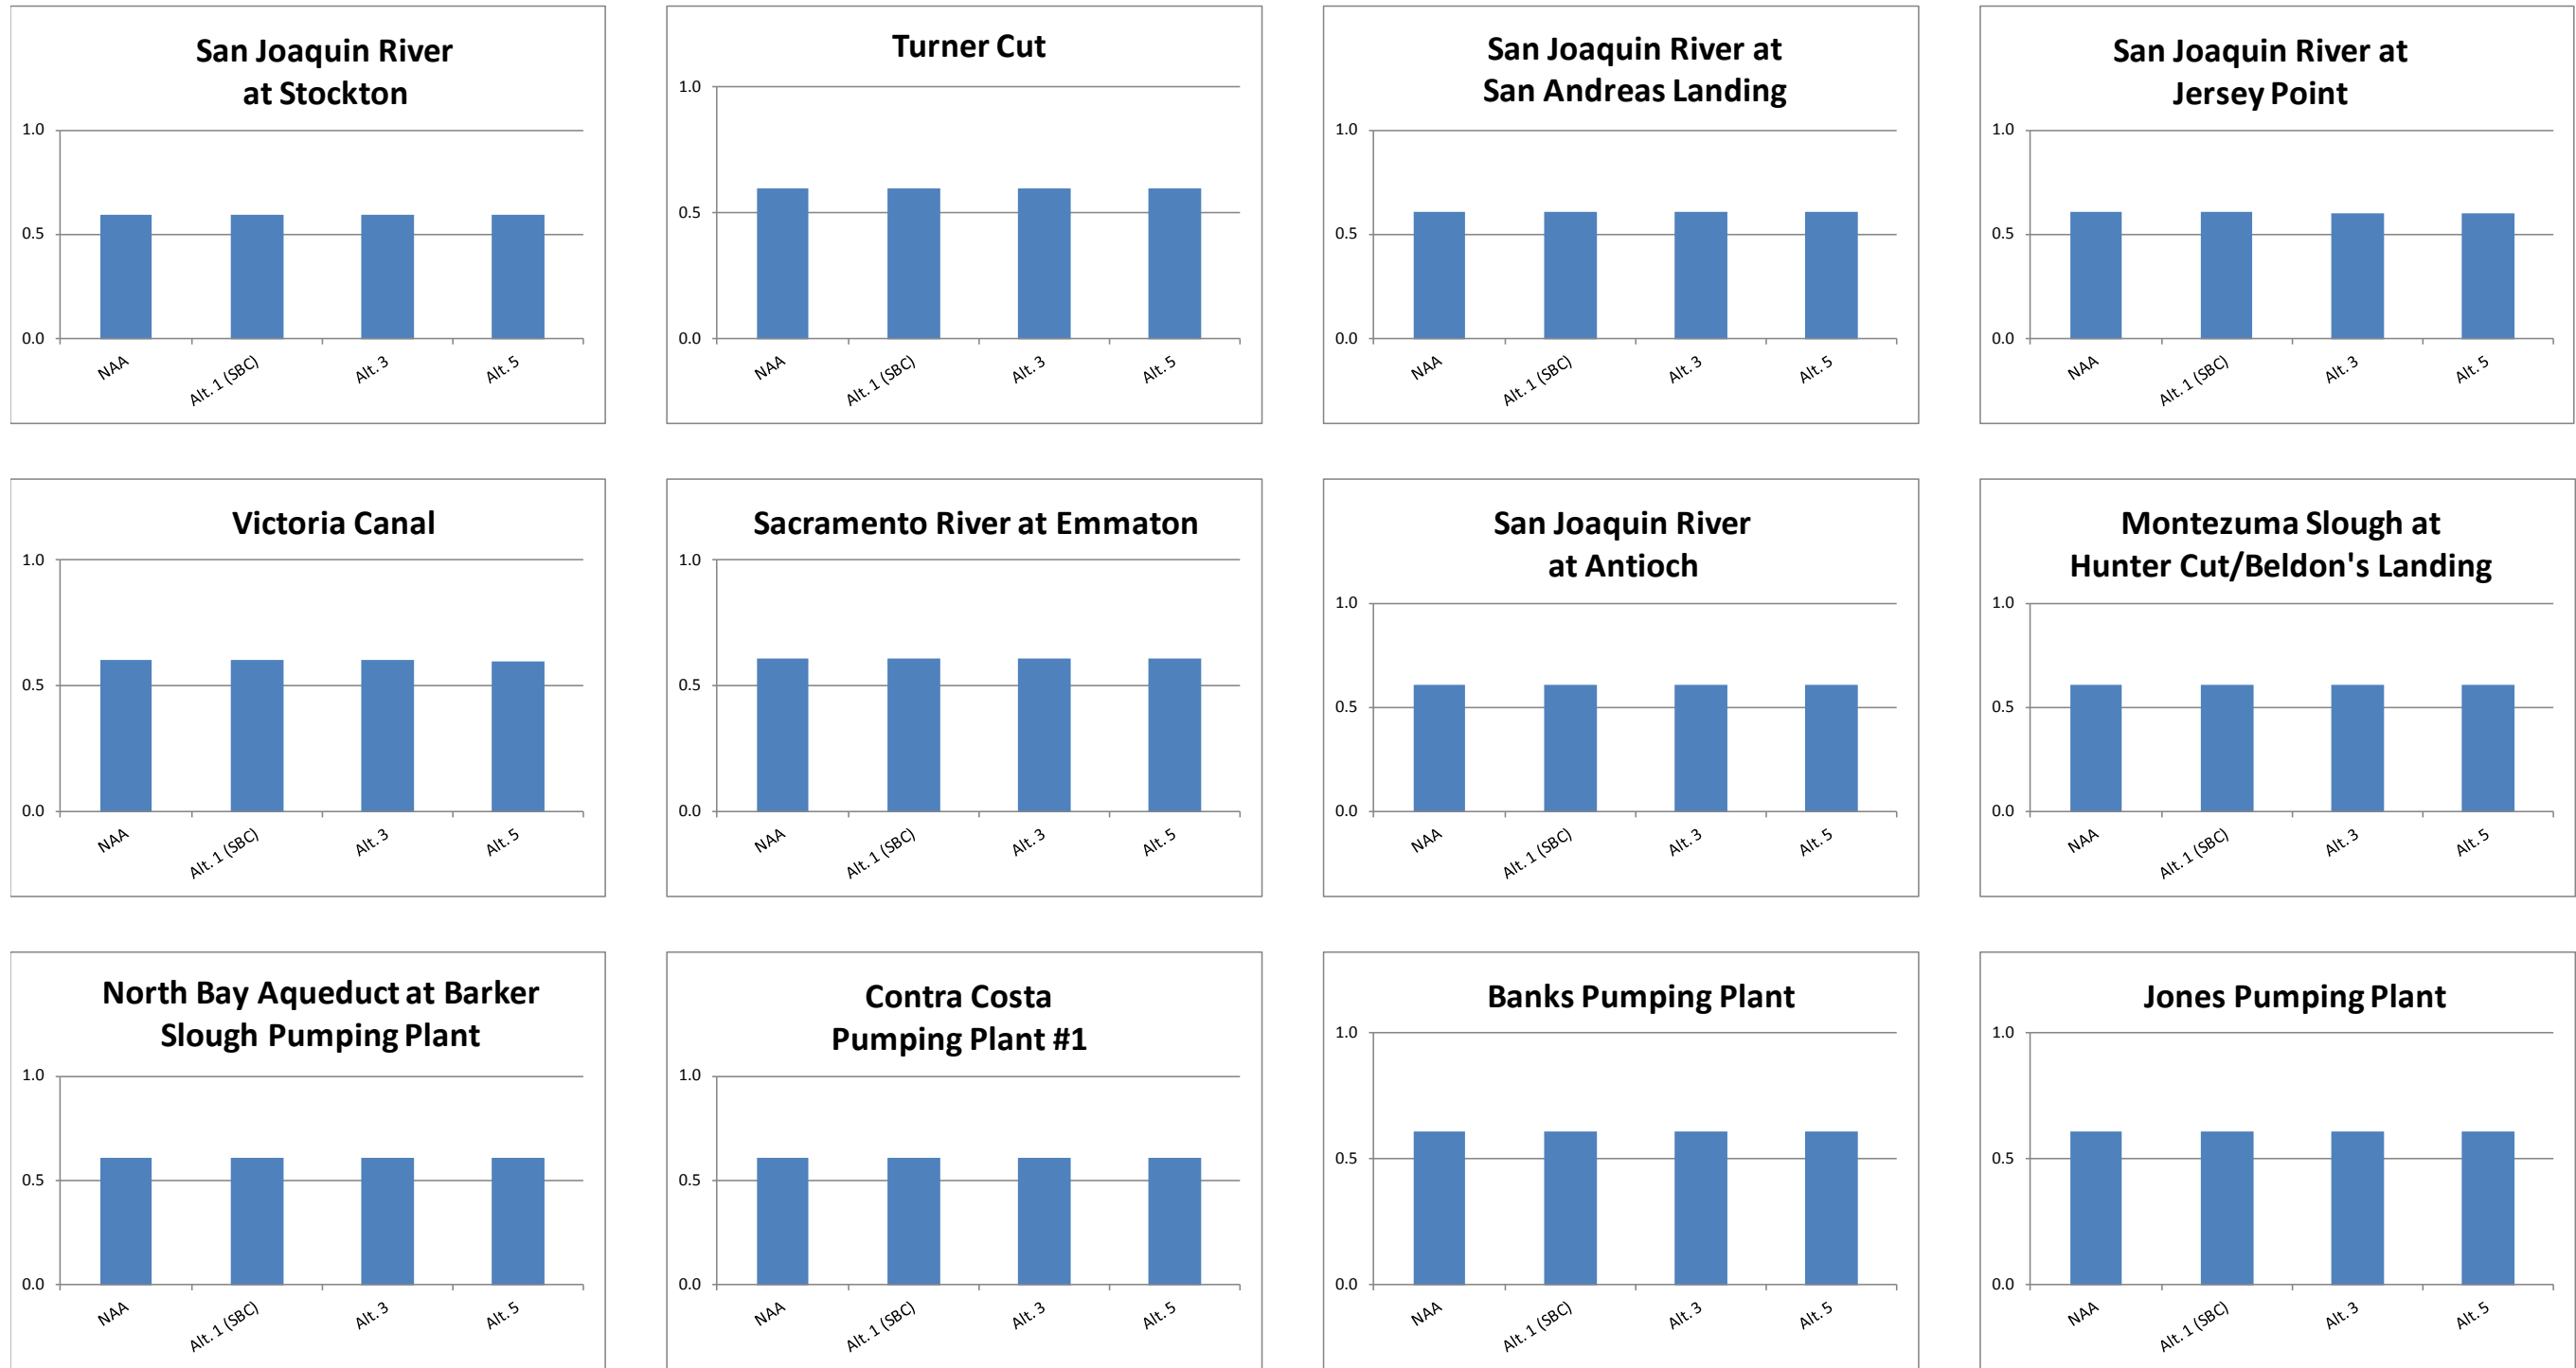


1
2 **Figure 6D.8 Level of Concern Exceedance Quotients for Selenium Concentrations in Bird Eggs (Invertebrate Diet) for Drought Years**

3 "Alt. 1 (SBC)" is the same as Second Basis of Comparison. This nomenclature was used in this appendix to be consistent with the model run output for the model run that represents both Second Basis of Comparison and Alternative 1.
4 Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 4 results are not presented separately. Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2
5 results are not presented separately.

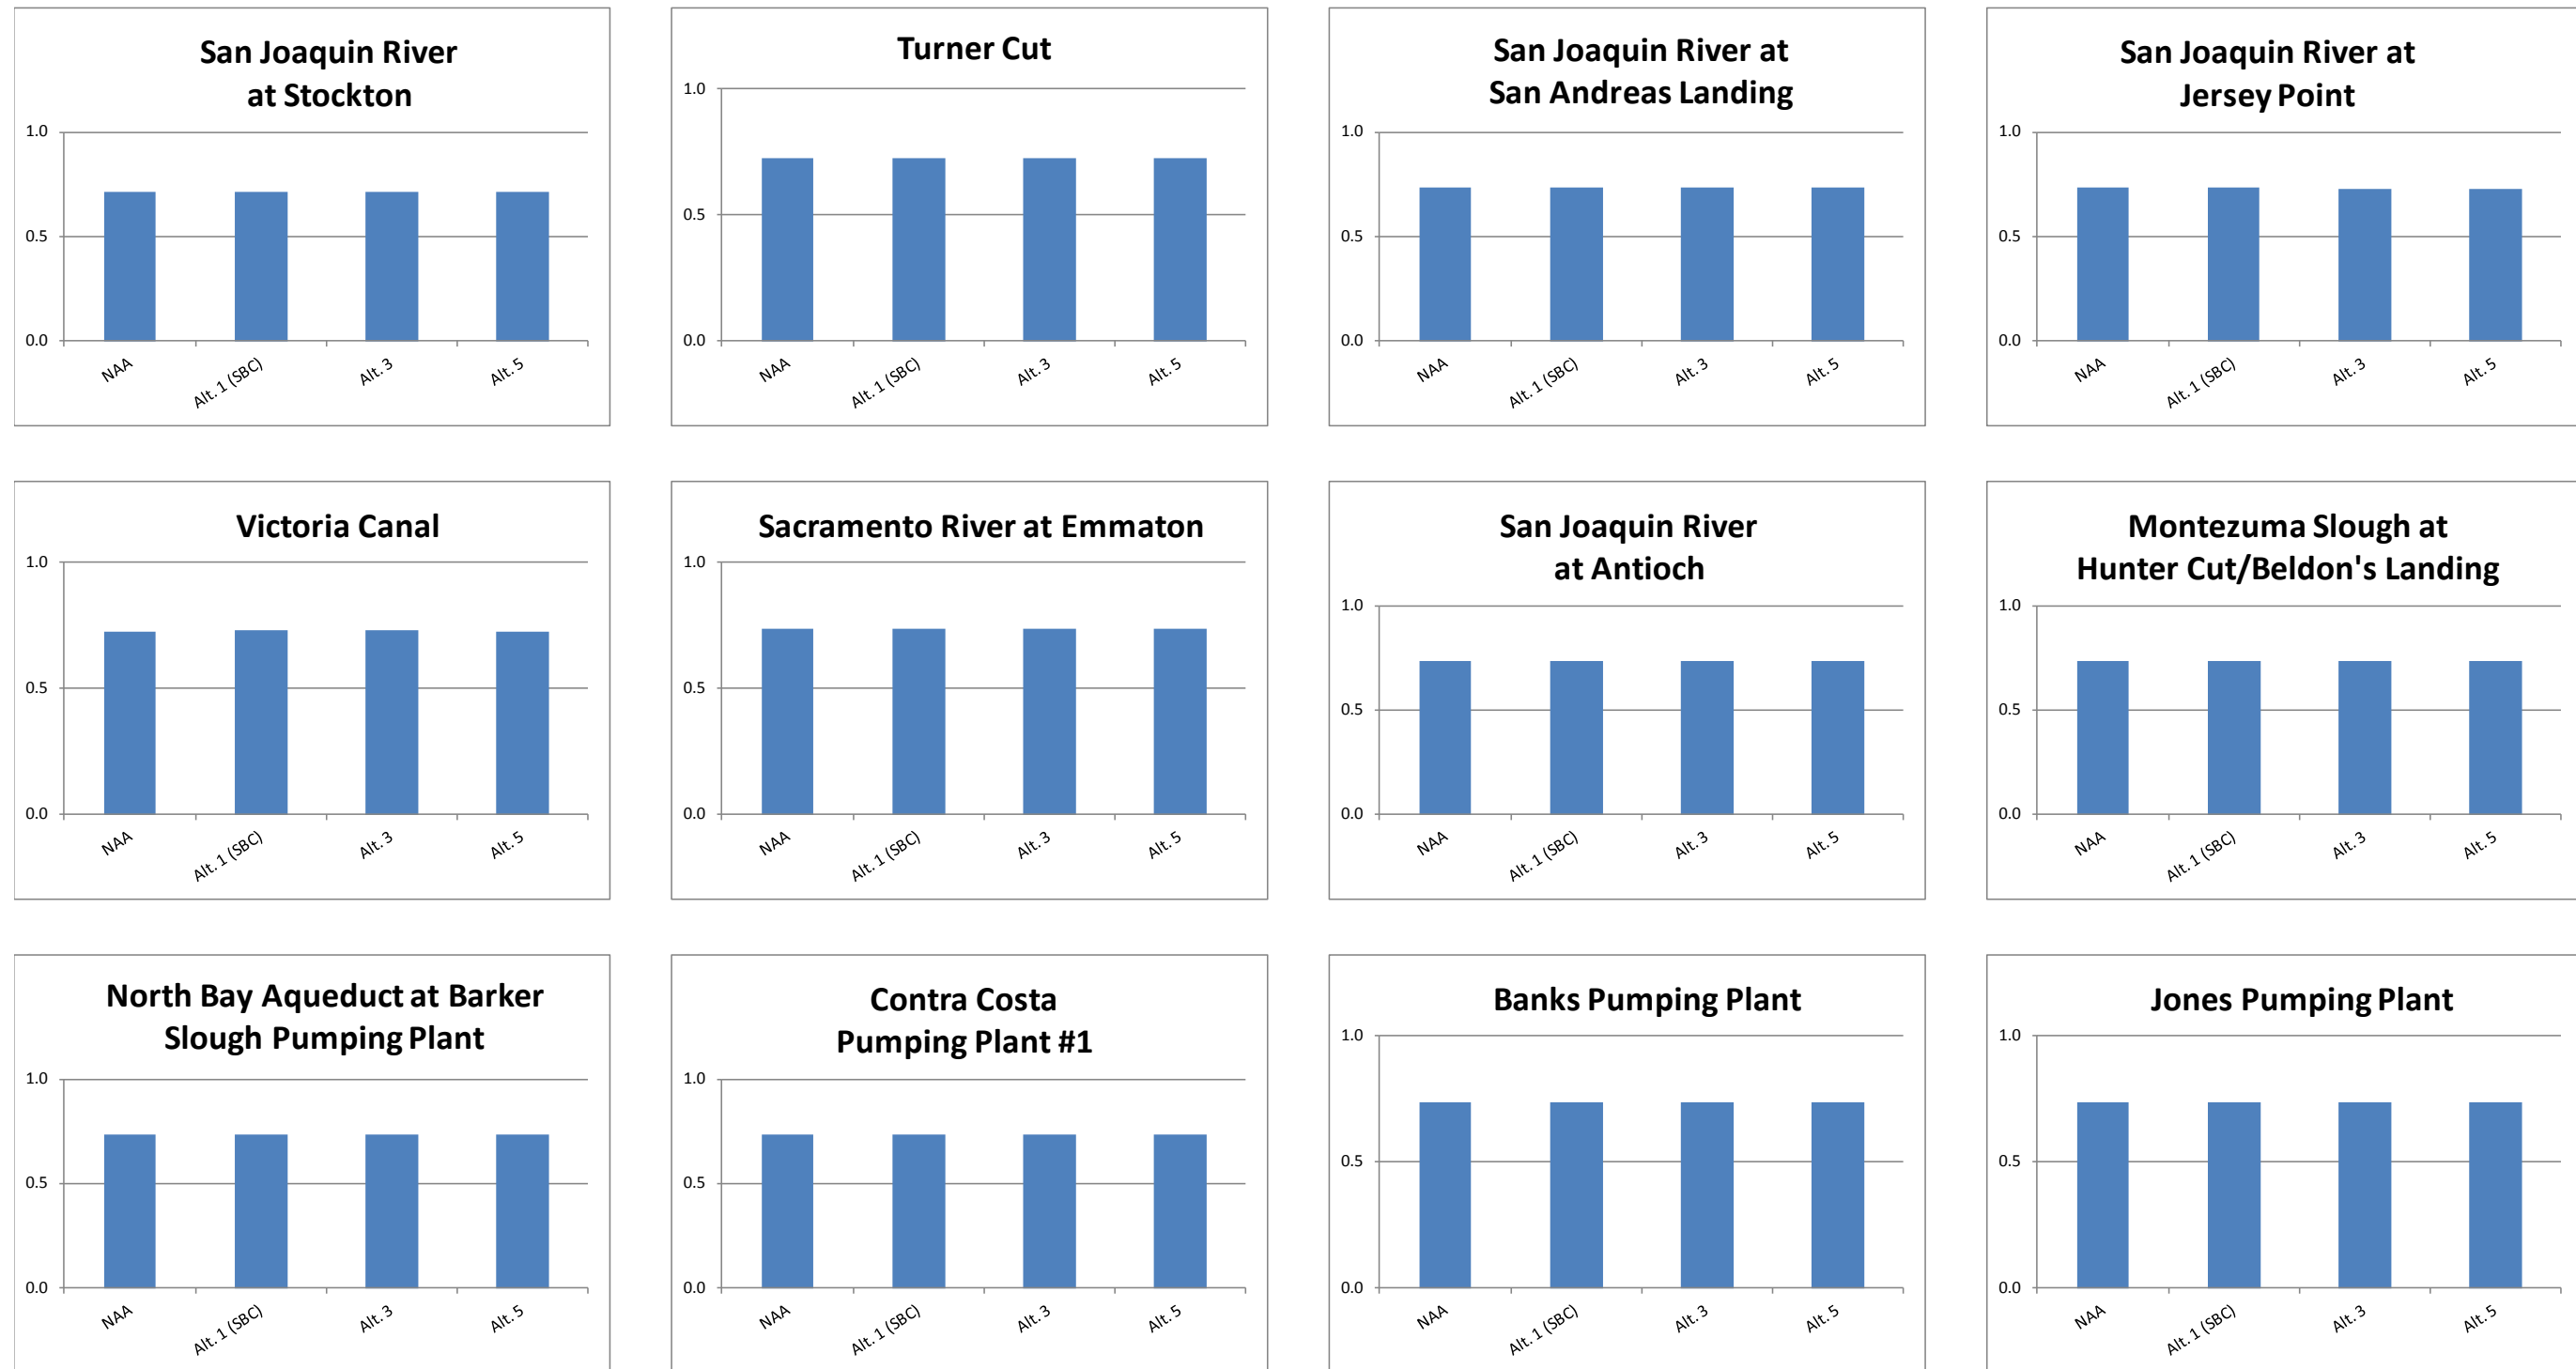


1
2 **Figure 6D.9 Level of Concern Exceedance Quotients for Selenium Concentrations in Bird Eggs (Fish Diet) for Drought Years**

3 "Alt. 1 (SBC)" is the same as Second Basis of Comparison. This nomenclature was used in this appendix to be consistent with the model run output for the model run that represents both Second Basis of Comparison and Alternative 1.
4 Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 4 results are not presented separately. Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2
5 results are not presented separately.

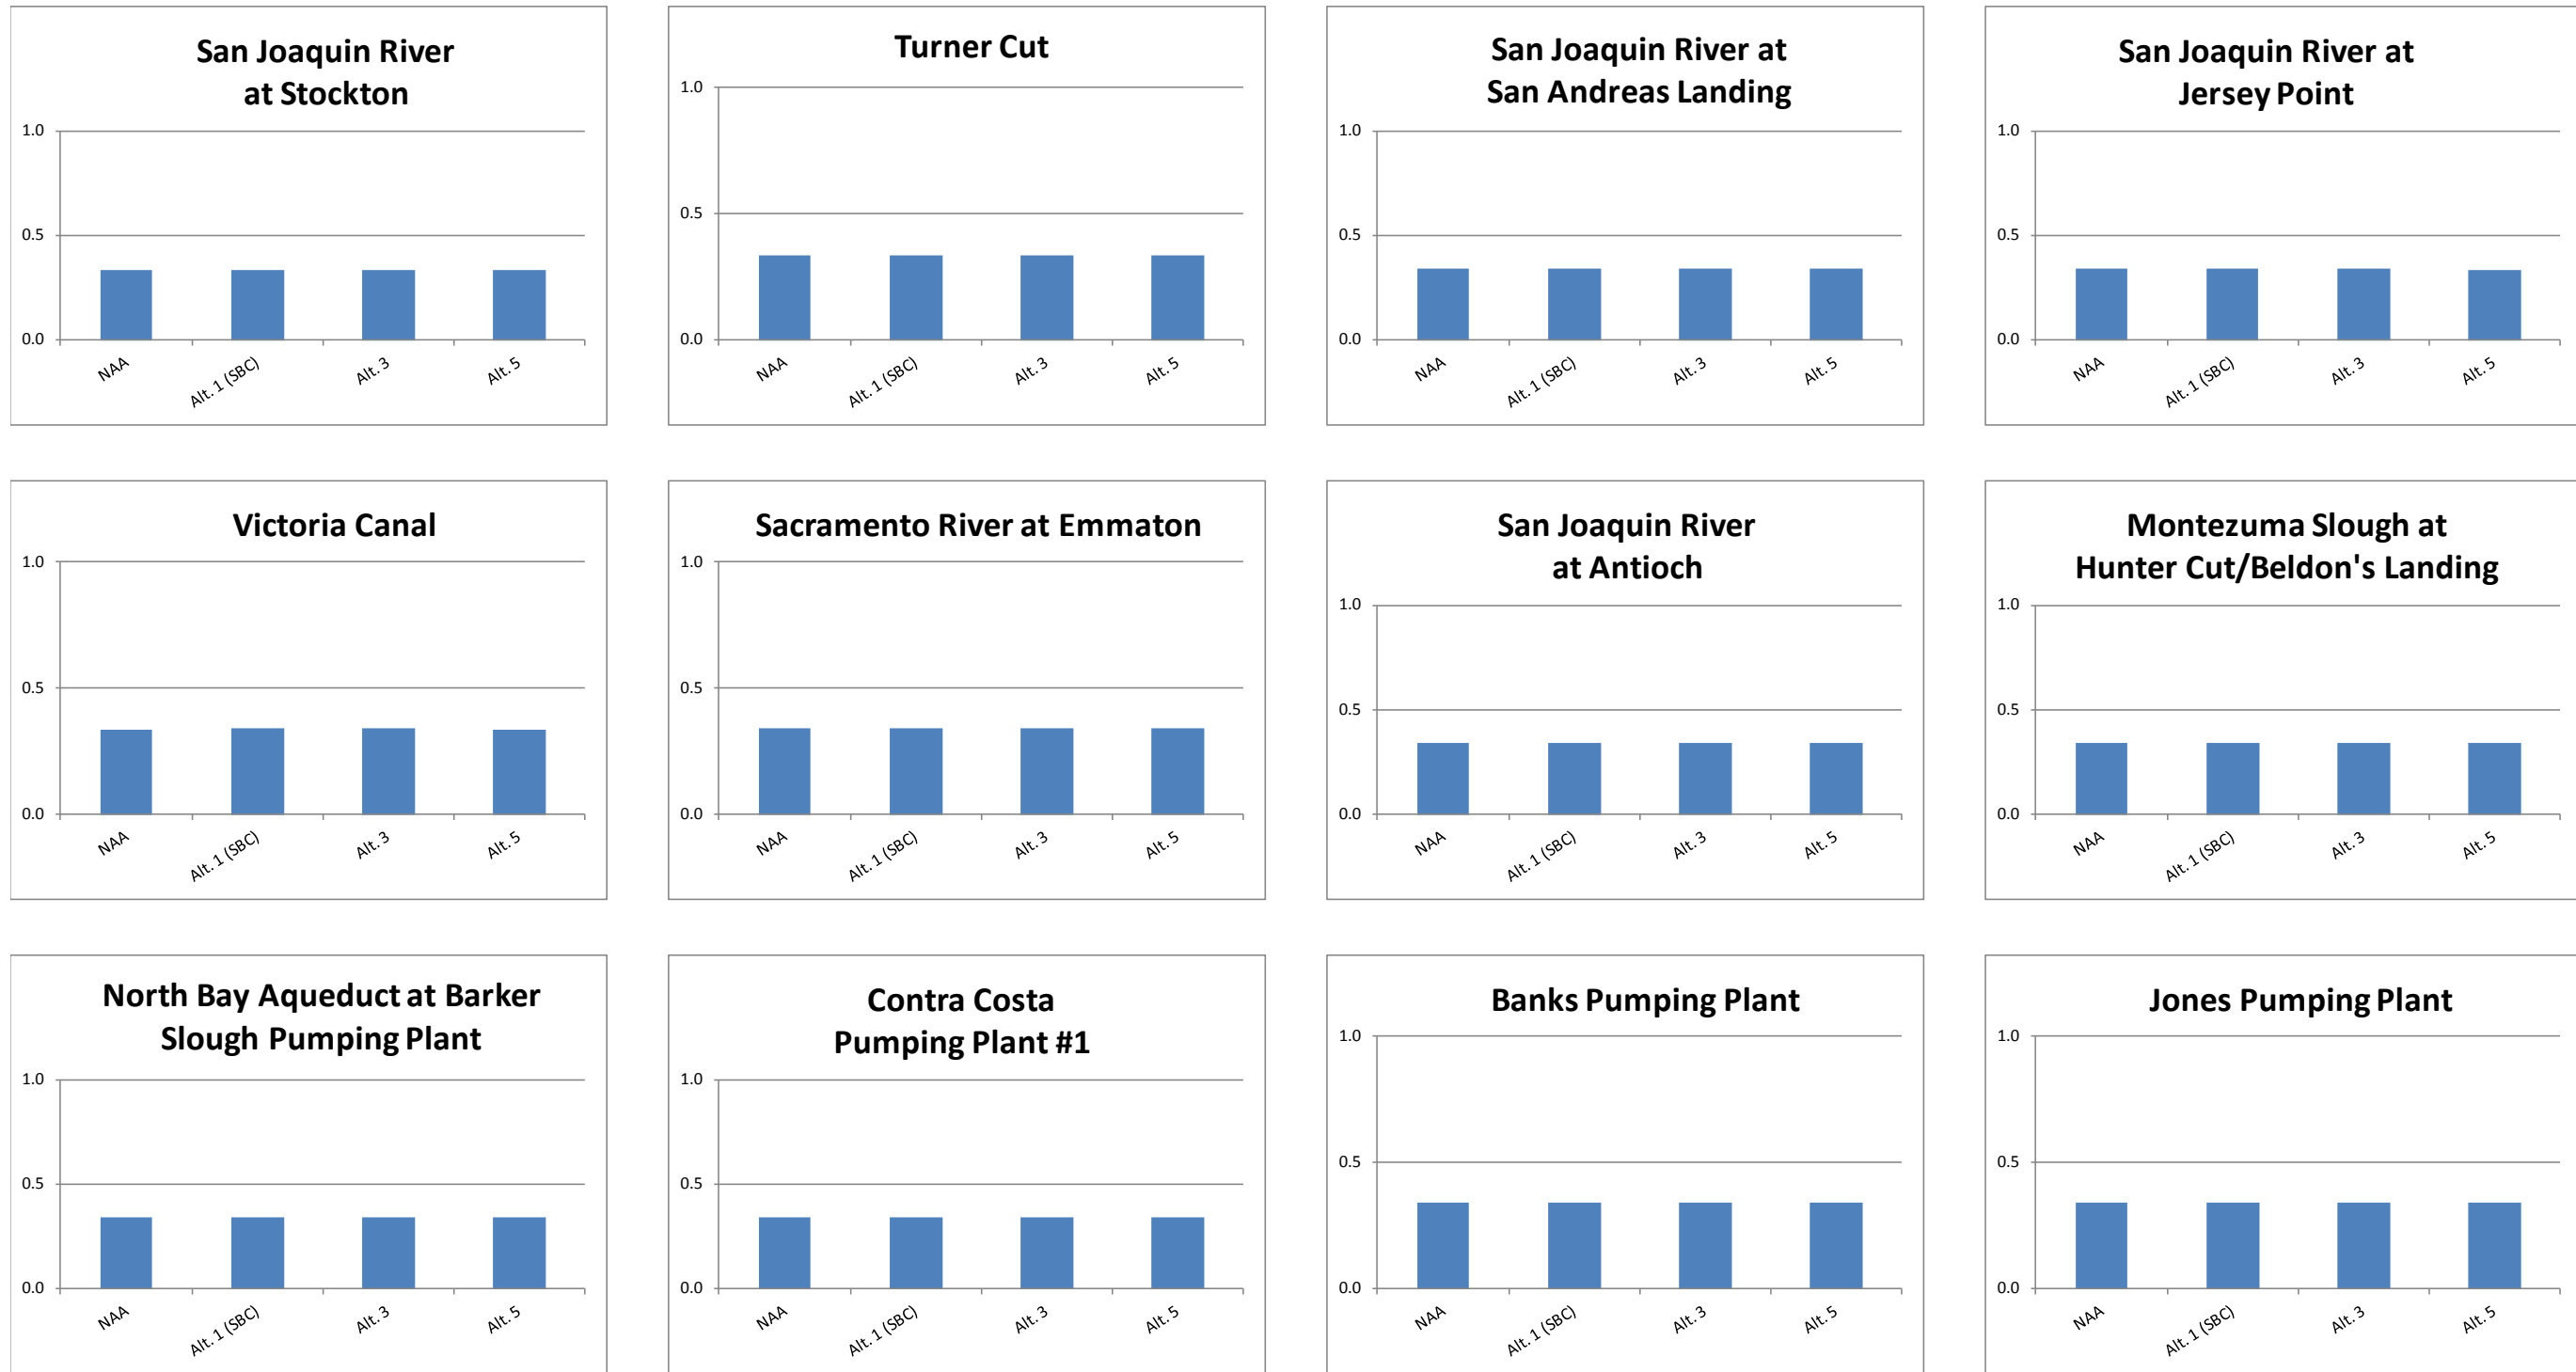

1
2 **Figure 6D.10 Level of Concern Exceedance Quotients for Selenium Concentrations in Fish Fillets (wet weight) for Drought Years**

3 "Alt. 1 (SBC)" is the same as Second Basis of Comparison. This nomenclature was used in this appendix to be consistent with the model run output for the model run that represents both Second Basis of Comparison and Alternative 1.
4 Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 4 results are not presented separately. Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2
5 results are not presented separately.

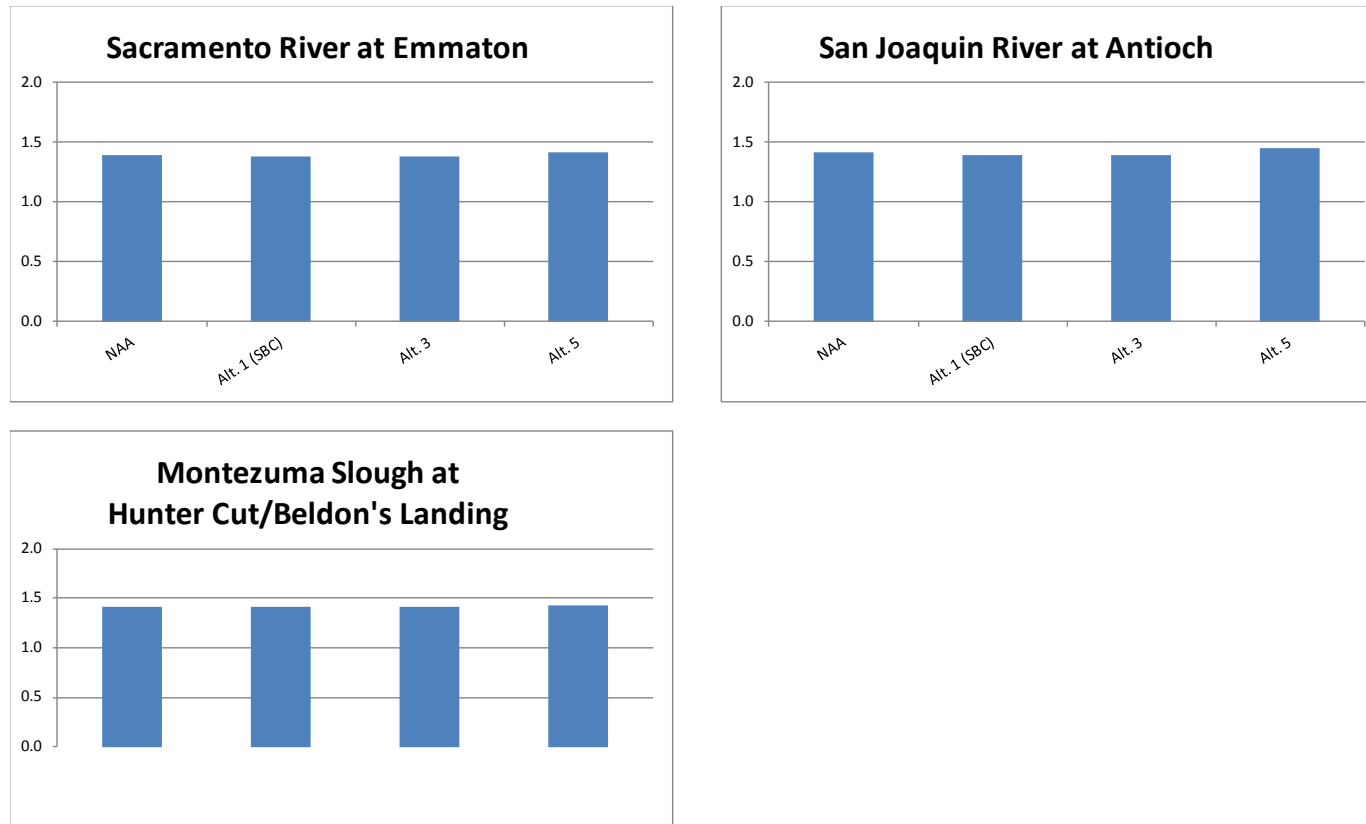

1
 2 **Figure 6D.11 Low Toxicity Threshold Exceedance Quotients for Selenium Concentrations in Whole-body Sturgeon for Drought Years**
 3 “Alt. 1 (SBC)” is the same as Second Basis of Comparison. This nomenclature was used in this appendix to be consistent with the model run
 4 output for the model run that represents both Second Basis of Comparison and Alternative 1.
 5 Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 4 results are not presented separately.
 6 Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented separately.

This page left blank intentionally.

1 **Appendix 6E**

2 **Analysis of Delta Salinity Indicators**

3 This appendix provides information about the methods and assumptions used for
 4 the Coordinated Long-Term Operation of the Central Valley Project (CVP) and
 5 State Water Project (SWP) Environmental Impact Statement (EIS) analysis for
 6 Delta salinity indicators. It is organized into two main sections that are briefly
 7 described below:

- 8 • Section 6E.1: Analysis of Delta Salinity Indicators Methodology and
 9 Assumptions
 - 10 – The impacts analysis for Delta salinity indicators uses the DSM2-QUAL
 11 model to quantify changes in salinity, chloride, and bromide
 12 concentrations. This section describes the overall analytical approach and
 13 assumptions for simulations of the No Action Alternative, Second Basis of
 14 Comparison, and the other alternatives.
- 15 • Section 6E.2: Analysis of Delta Salinity Indicators Results
 - 16 – This section presents the results for salinity, chloride concentration, and
 17 bromide concentration at different locations within in the Delta.

18 **6E.1 Analysis of Delta Salinity Indicators**
 19 **Methodology and Assumptions**

20 **6E.1.1 Analysis Methodology**

21 To evaluate the potential effects on water quality within the Delta, three different
 22 parameters were quantified: salinity (measured as Electrical Conductivity [EC]),
 23 chloride concentration, and bromide concentration. This section describes how
 24 these parameters were estimated for the analysis.

25 **6E.1.1.1 Salinity**

26 Monthly average salinity in the Delta was estimated at select locations within the
 27 Delta in terms of EC (in units of micromhos per centimeter [$\mu\text{mhos/cm}$]) using
 28 the DSM2-QUAL model for all the alternatives. Refer to Appendix 5A,
 29 Section A for a detailed description of the DSM2-QUAL model.

30 **6E.1.1.2 Chloride Concentration**

31 Monthly average chloride concentration at primarily diversion and export
 32 locations within the Delta was calculated based on the maximum of the following
 33 regression equations taken from CalSim II:

34
$$CCI^- = EC * 0.285 - 50$$

35
$$CCI^- = EC * 0.15 - 12$$

1 *where: EC is the monthly average Electrical Conductivity value at the*
2 *export location and CCl- is the monthly average chloride concentration*
3 *in mg/L*

4 The regression equations calculate chloride concentrations based on whether the
5 location is riverine or seawater dominant. To be conservative, the maximum of
6 chloride concentration calculated using the above two equations was used. The
7 EC value in this equation is the salinity value described previously that is output
8 from the DSM2-QUAL model.

9 **6E.1.1.3 Bromide Concentration**

10 Monthly average bromide concentration at diversion and export locations within
11 the Delta was calculated based on the following regression equations from the
12 California Department of Water Resources (DWR) 33rd Annual Progress Report
13 (DWR 2012):

14 *if VolFpMartinez <0.4 then CBr- = EC*0.0004-0.0364*

15 *if VolFpMartinez >0.4 then CBr- = EC*0.0000827-0.1117*

16 *where: VolFpMartinez is the monthly average Martinez Source Water*
17 *(Volumetric) Fingerprinting value at the location, EC is the monthly*
18 *average Electrical Conductivity (µmhos/cm) value at the export location*
19 *and CBr- is the monthly average bromide concentration (mg/L)*

20 The Volumetric Fingerprinting and EC values (the same salinity value used for
21 the chloride calculation) in this equation are both outputs of the DSM2-QUAL
22 model, and methodology for estimating these parameters is described in
23 Appendix 5A, Section A.

24 **6E.1.2 Analysis Scenario Assumptions**

25 This section describes the assumptions for the Analysis of the Delta Salinity
26 Indicators for the No Action Alternative, Second Basis of Comparison, and other
27 alternatives.

28 The following CalSim II model simulations were performed as the basis of
29 evaluating the impacts of Alternatives 1 through 5 as compared to the No Action
30 Alternative, and the No Action Alternative and Alternatives 1 through 5 as
31 compared to the Second Basis of Comparison:

- 32 • No Action Alternative
33 • Second Basis of Comparison

34 The following model simulations of other alternatives were performed:

- 35 • Alternative 1 – for simulation purposes, considered the same as Second Basis
36 of Comparison
37 • Alternative 2 – for simulation purposes, considered the same as No Action
38 Alternative
39 • Alternative 3

- 1 • Alternative 4 – for simulation purposes, considered the same as Second Basis
 2 of Comparison.
- 3 • Alternative 5
- 4 Assumptions for each of these alternatives were developed with the surface water
 5 modeling tools and are described in Appendix 5A, Section B.
- 6 Assumptions for each of these alternatives are reflected to monthly CalSim II
 7 flows that are input into the DSM2 model to generate the salinity results described
 8 in this section. The salinity (EC) results are then used to calculate the chloride
 9 and bromide concentrations based on the equations described in this section. The
 10 equations described above pertain to all alternatives.

11 **6E.2 Analysis of Delta Salinity Indicators Results**

12 Results are provided for each of the following runs separately:

- 13 • No Action Alternative
- 14 • Second Basis of Comparison
- 15 • Alternative 1
- 16 • Alternative 3
- 17 • Alternative 5

18 Model results for Alternatives 1, 4, and Second Basis of Comparison are the
 19 same, therefore Alternative 4 results are not presented separately. Model results
 20 for Alternative 2 and No Action Alternative are the same, therefore Alternative 2
 21 results are not presented separately.

22 In addition, the same statistics are provided for the following comparisons to
 23 establish changes of the alternative with respect to one of the bases of
 24 comparison:

- 25 • Alternative 1 compared to No Action Alternative
- 26 • Alternative 3 compared to No Action Alternative
- 27 • Alternative 5 compared to No Action Alternative
- 28 • No Action Alternative compared to Second Basis of Comparison
- 29 • Alternative 3 compared to Second Basis of Comparison
- 30 • Alternative 5 compared to Second Basis of Comparison

31 The first set of results is provided as probability of exceedance curves of salinity
 32 (EC) for select locations within the Delta. For this analysis, exceedance plots for
 33 monthly average EC were generated based on the 82-year CalSim II time period
 34 for each of the alternatives and bases of comparison. Differences among
 35 alternatives were evaluated using the exceedance probability corresponding to
 36 varying levels of salinity. The first set of results is provided as the following
 37 figures:

- 38 • B.1. Sacramento River downstream of Steamboat Slough Salinity
 39 (Figures 6E.B.1.1. through 6E.B.1.12.)

Appendix 6E: Analysis of Delta Salinity Indicators

- 1 • B.2. Sacramento River at Emmaton Salinity (Figures 6E.B.2.1. through
2 6E.B.2.12.)
- 3 • B.3. San Joaquin River at Jersey Point Salinity (Figures 6E.B.3.1. through
4 6E.B.3.12.)
- 5 • B.4. Sacramento River at Collinsville Salinity (Figures 6E.B.4.1. through
6 6E.B.4.12.)
- 7 • B.5. Sacramento River at Mallard Slough Salinity (Figures 6E.B.5.1. through
8 6E.B.5.12.)
- 9 • B.6. Sacramento River at Port Chicago Salinity (Figures 6E.B.6.1. through
10 6E.B.6.12.)
- 11 • B.7. Jones Pumping Plant Salinity (Figures 6E.B.7.1. through 6E.B.7.12.)
- 12 • B.8. Banks Pumping Plant Salinity (Figures 6E.B.8.1. through 6E.B.8.12.)
- 13 • B.9. Antioch Salinity (Figures 6E.B.9.1. through 6E.B.9.12.)
- 14 • B.10.1. Chipps Island North Channel Salinity (Figures 6E.B.10.1.1. through
15 6E.B.10.1.12.)
- 16 • B.10.2. Chipps Island South Channel Salinity (Figures 6E.B.10.2.1. through
17 6E.B.10.2.12.)
- 18 • B.11. Old River at Rock Slough Salinity (Figures 6E.B.11.1. through
19 6E.B.11.12.)
- 20 • B.12. Contra Costa Water District Old River Intake Salinity
21 (Figures 6E.B.12.1. through 6E.B.12.12.)
- 22 • B.13. Contra Costa Water District Victoria Canal Intake Salinity
23 (Figures 6E.B.13.1. through 6E.B.13.12.)
- 24 • B.14. Barker Slough North Bay Aqueduct Intake Salinity (Figures 6E.B.14.1.
25 through 6E.B.14.12.)
- 26 • B.15. San Joaquin River at Vernalis Salinity (Figures 6E.B.15.1. through
27 6E.B.15.12.)

28 A discussion of results and impact assessment is provided in the Environmental
29 Consequences section of Chapter 6.

30 The second set of results is provided as tables summarizing the EC as well as
31 chloride and bromide concentrations at select locations within the Delta with
32 long-term averages over the entire CalSim II simulation period. Averages are
33 also provided by water year type.

34 As noted earlier, EC was used as surrogate for Delta salinity results.

35 The following results are presented in this section:

- 36 • B.1. Sacramento River downstream of Steamboat Slough Salinity
37 (Tables 6E.B.1.1. through 6E.B.1.6.)

- 1 • B.2. Sacramento River at Emmaton Salinity (Tables 6E.B.2.1. through
2 6E.B.2.6.)
- 3 • B.3. San Joaquin River at Jersey Point Salinity (Tables 6E.B.3.1. through
4 6E.B.3.6.)
- 5 • B.4. Sacramento River at Collinsville Salinity (Tables 6E.B.4.1. through
6 6E.B.4.6.)
- 7 • B.5. Sacramento River at Mallard Slough Salinity (Tables 6E.B.5.1. through
8 6E.B.5.6.)
- 9 • B.6. Sacramento River at Port Chicago Salinity (Tables 6E.B.6.1. through
10 6E.B.6.6.)
- 11 • B.7. Jones Pumping Plant Salinity (Tables 6E.B.7.1. through 6E.B.7.6.)
- 12 • B.8. Banks Pumping Plant Salinity (Tables 6E.B.8.1. through 6E.B.8.6.)
- 13 • B.9. Antioch Salinity (Tables 6E.B.9.1. through 6E.B.9.6.)
- 14 • B.10.1. Chipps Island North Channel Salinity (Tables 6E.B.10.1.1. through
15 6E.B.10.1.6.)
- 16 • B.10.2. Chipps Island South Channel Salinity (Tables 6E.B.10.2.1. through
17 6E.B.10.2.6.)
- 18 • B.11. Old River at Rock Slough Salinity (Tables 6E.B.11.1. through
19 6E.B.11.6.)
- 20 • B.12. Contra Costa Water District Old River Intake Salinity
21 (Tables 6E.B.12.1. through 6E.B.12.6.)
- 22 • B.13. Contra Costa Water District Victoria Canal Intake Salinity
23 (Tables 6E.B.13.1. through 6E.B.13.6.)
- 24 • B.14. Barker Slough North Bay Aqueduct Intake Salinity (Tables 6E.B.14.1.
25 through 6E.B.14.6.)
- 26 • B.15. San Joaquin River at Vernalis Salinity (Tables 6E.B.15.1. through
27 6E.B.15.6.)
- 28 • B.16. Sacramento River at Mallard Slough Chloride Concentration
29 (Tables 6E.B.16.1. through 6E.B.16.6.)
- 30 • B.17. Jones Pumping Plant Chloride Concentration (Tables 6E.B.17.1.
31 through 6E.B.17.6.)
- 32 • B.18. Banks Pumping Plant Chloride Concentration (Tables 6E.B.18.1.
33 through 6E.B.18.6.)
- 34 • B.19. Old River at Rock Slough Chloride Concentration (Tables 6E.B.19.1.
35 through 6E.B.19.6.)
- 36 • B.20. Contra Costa Water District Old River Intake Chloride Concentration
37 (Tables 6E.B.20.1. through 6E.B.20.6.)

Appendix 6E: Analysis of Delta Salinity Indicators

- 1 • B.21. Contra Costa Water District Victoria Canal Intake Chloride
2 Concentration (Tables 6E.B.21.1. through 6E.B.21.6.)
- 3 • B.22. Antioch Chloride Concentration (Tables 6E.B.22.1. through 6E.B.22.6.)
- 4 • B.23. Jones Pumping Plant Bromide Concentration (Tables 6E.B.23.1.
5 through 6E.B.23.6.)
- 6 • B.24. Banks Pumping Plant Bromide Concentration (Tables 6E.B.24.1.
7 through 6E.B.24.6.)
- 8 • B.25. Old River at Rock Slough Bromide Concentration (Tables 6E.B.25.1.
9 through 6E.B.25.6.)
- 10 • B.26. Contra Costa Water District Old River Intake Bromide Concentration
11 (Tables 6E.B.26.1. through 6E.B.26.6.)
- 12 • B.27. Contra Costa Water District Victoria Canal Intake Bromide
13 Concentration (Tables 6E.B.27.1. through 6E.B.27.6.)

14 The third set of results provided are probability of exceedance curves that present
15 the differences between simulated salinity or chloride concentrations and the D-
16 1641 agricultural salinity standards or M&I chloride concentration standards for
17 select locations within the Delta. Each plot contains a dashed threshold line at the
18 zero value on the Y-Axis. Values above this line indicate the percentage of years
19 the applied D-1641 standard was exceeded. For this analysis, exceedance plots
20 were generated based on the 82-year simulation period for each alternative.

21 As noted earlier, EC was used as surrogate for Delta salinity results.

22 The following results are presented in this section:

- 23 • B.28. Sacramento River at Emmaton Compliance with D-1641 Agricultural
24 Salinity Standard
- 25 • B.29. San Joaquin River at Jersey Point Compliance with D-1641 Agricultural
26 Salinity Standard
- 27 • B.30. Contra Costa Canal at Pumping Plant #1 Compliance with D-1641 M&I
28 Chloride Standard
- 29 • B.31. San Joaquin River at Antioch Water Works Compliance with D-1641
30 M&I Chloride Standard
- 31 • B.32. West Canal at Mouth of Clifton Court Forebay Compliance with D-
32 1641 M&I Chloride Standard
- 33 • B.33. Delta-Mendota Canal at Tracy Pumping Plant Compliance with D-1641
34 M&I Chloride Standard
- 35 • B.34. Barker Slough at North Bay Aqueduct Compliance with D-1641 M&I
36 Chloride Standard
- 37 • B.35. Cache Slough at City of Vallejo Intake Compliance with D-1641 M&I
38 Chloride Standard

1 **6E.3 References**


- 2 DWR (California Department of Water Resources). 2012. “Chapter 5:
3 Estimating Delta-wide Bromide Using DSM2-Simulated EC Fingerprints.
4 Methodology for Flow and Salinity Estimates in the Sacramento-San
5 Joaquin Delta and Suisun Marsh”, 33rd Annual Progress Report.

1

This page left blank intentionally.


1 **B.1. Sacramento River downstream of Steamboat Slough**
2 **Salinity**

Figure 6E.B.1.1. Sacramento River d/s of Steamboat Slough Salinity, Electrical Conductivity, October

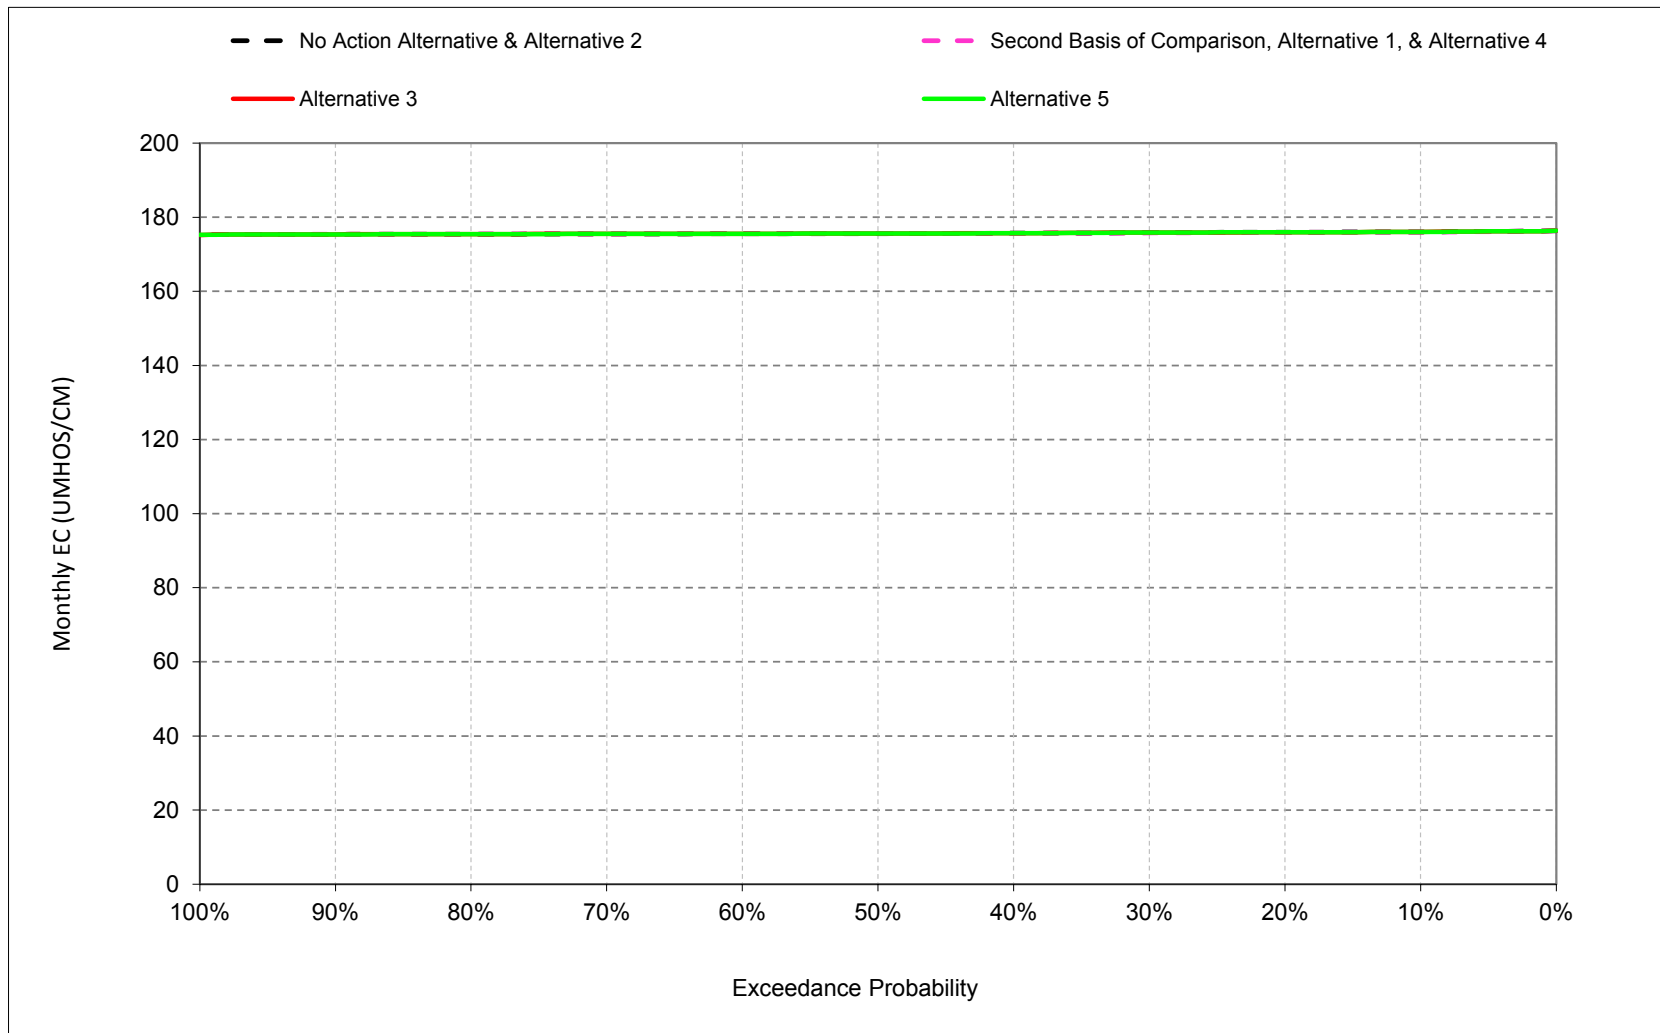


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.1.2. Sacramento River d/s of Steamboat Slough Salinity, Electrical Conductivity, November

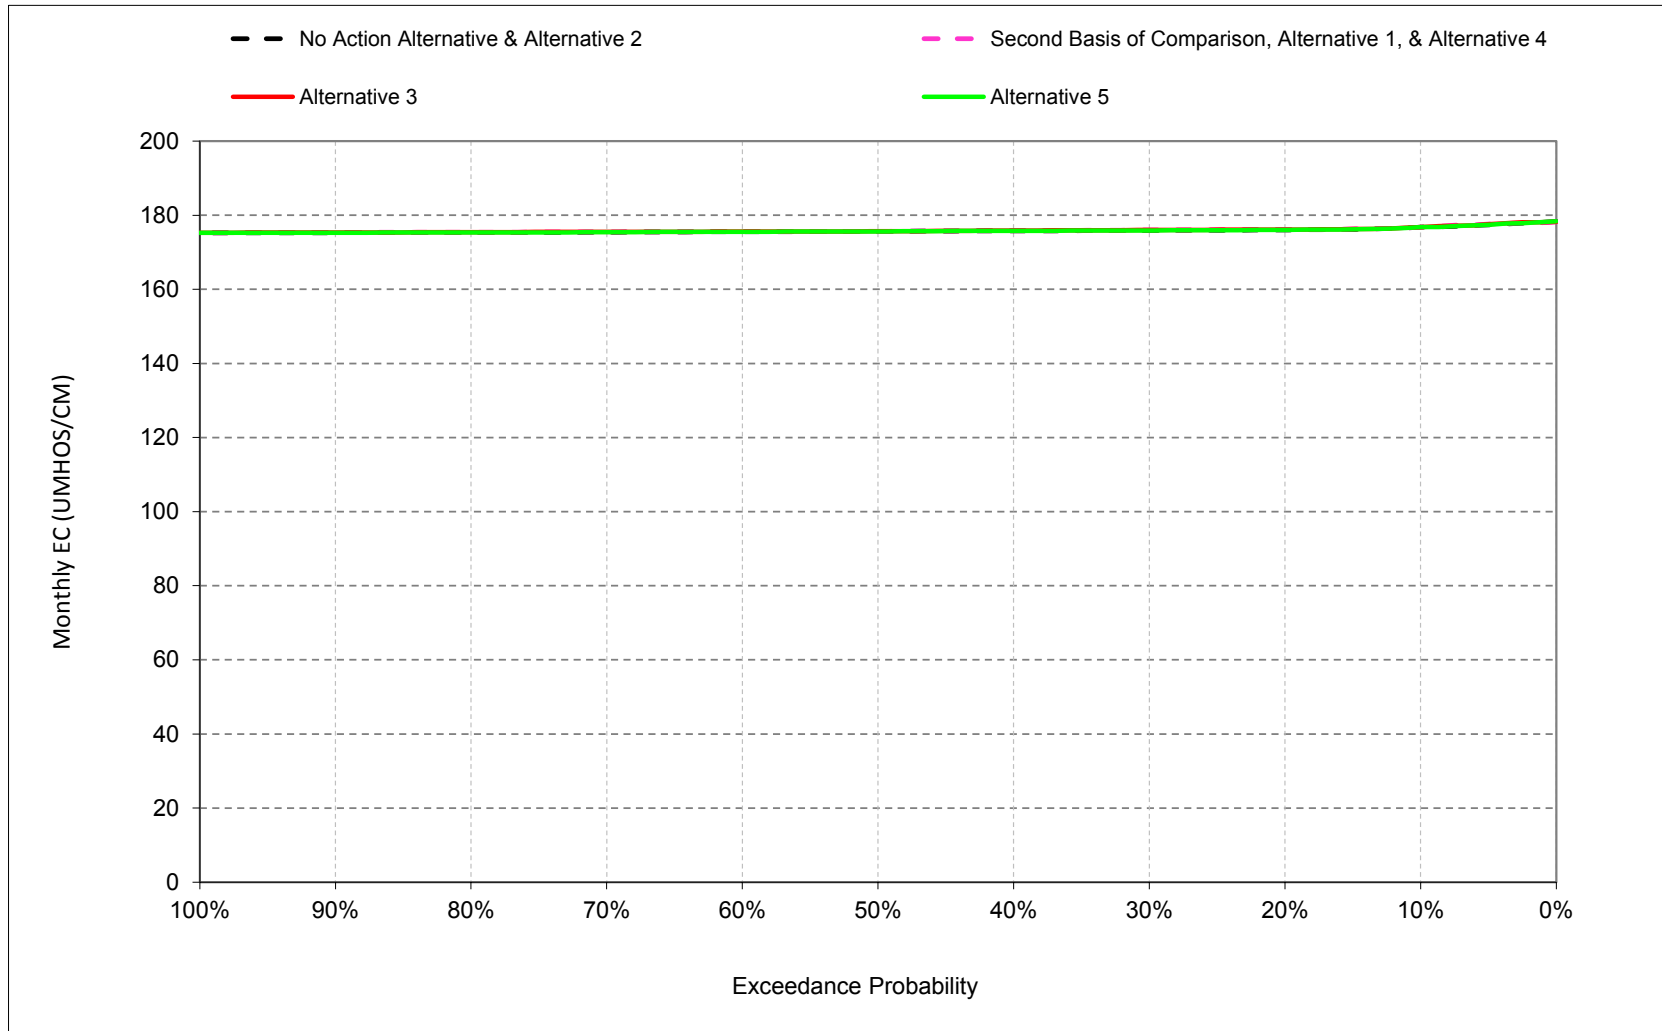


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.1.3. Sacramento River d/s of Steamboat Slough Salinity, Electrical Conductivity, December

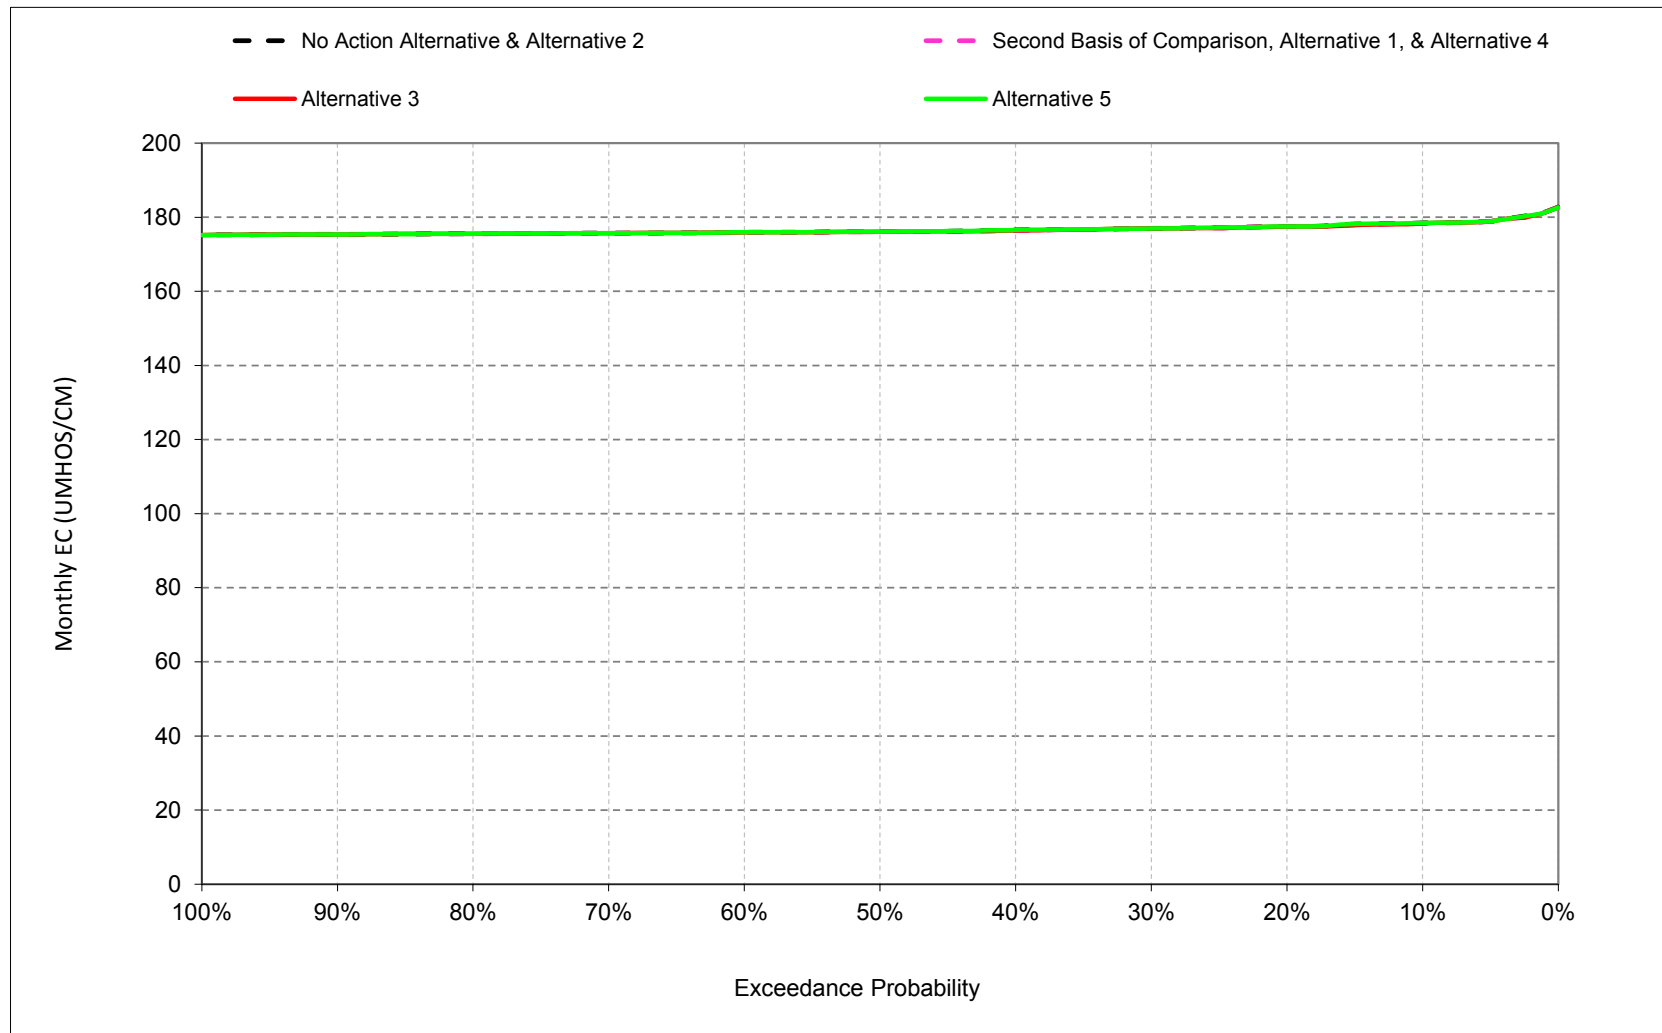


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.1.4. Sacramento River d/s of Steamboat Slough Salinity, Electrical Conductivity, January

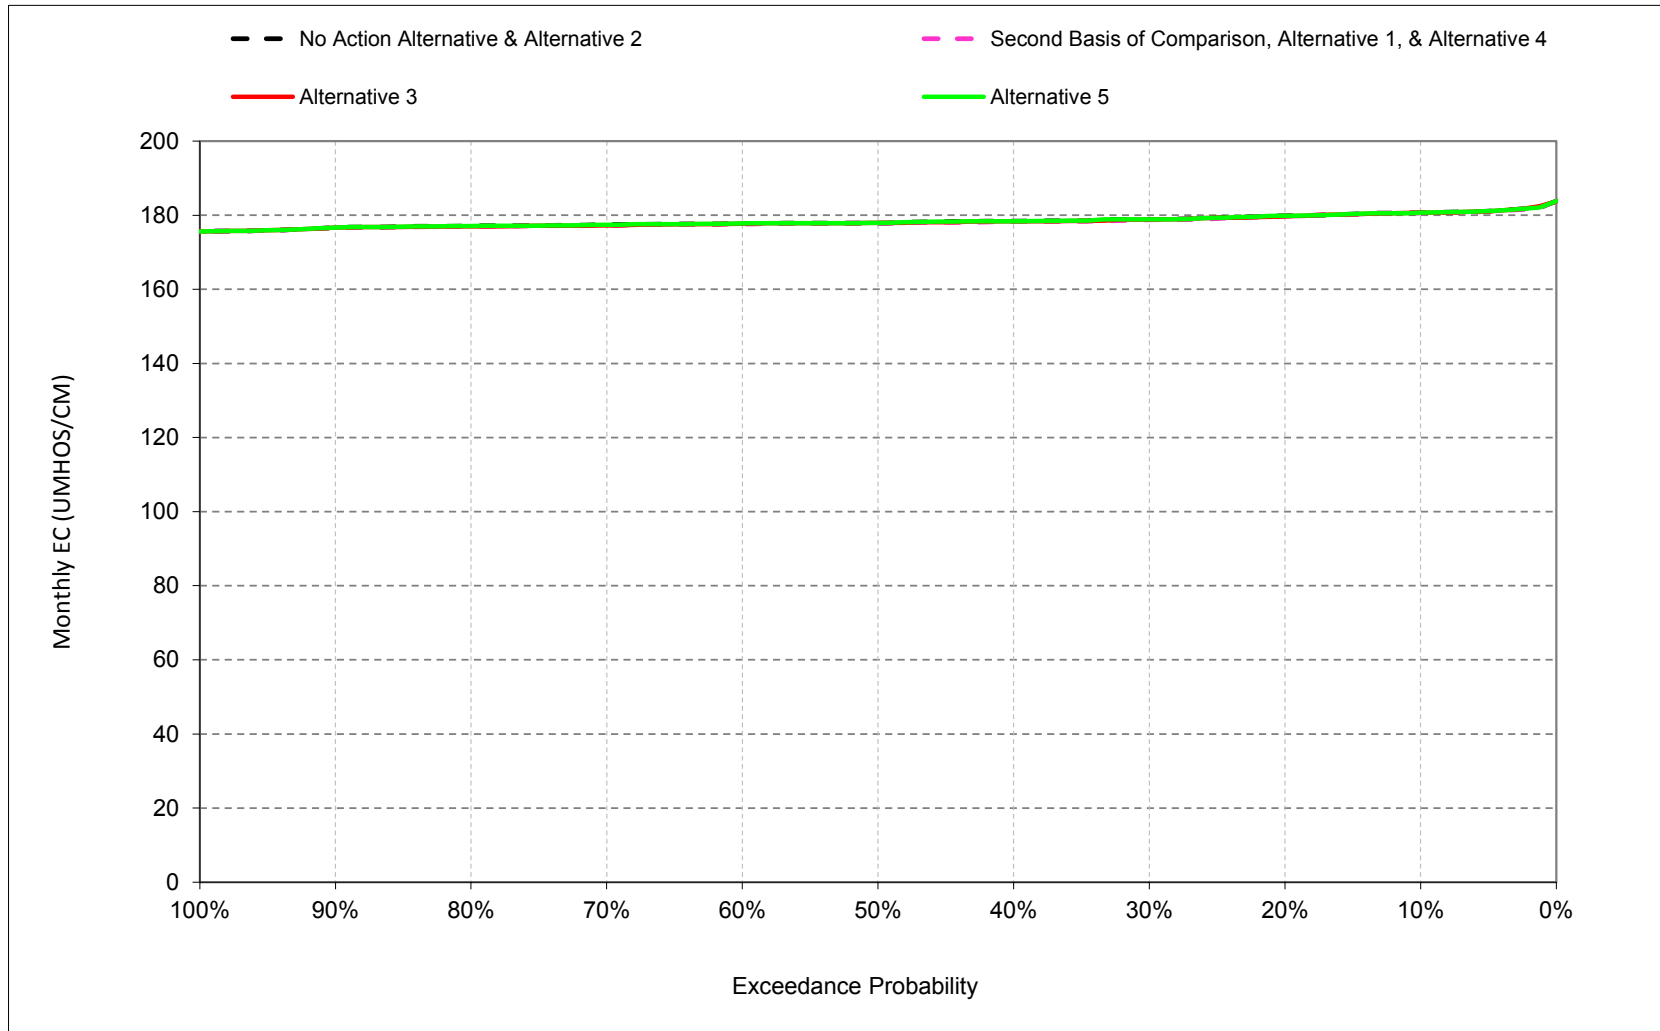


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.1.5. Sacramento River d/s of Steamboat Slough Salinity, Electrical Conductivity, February

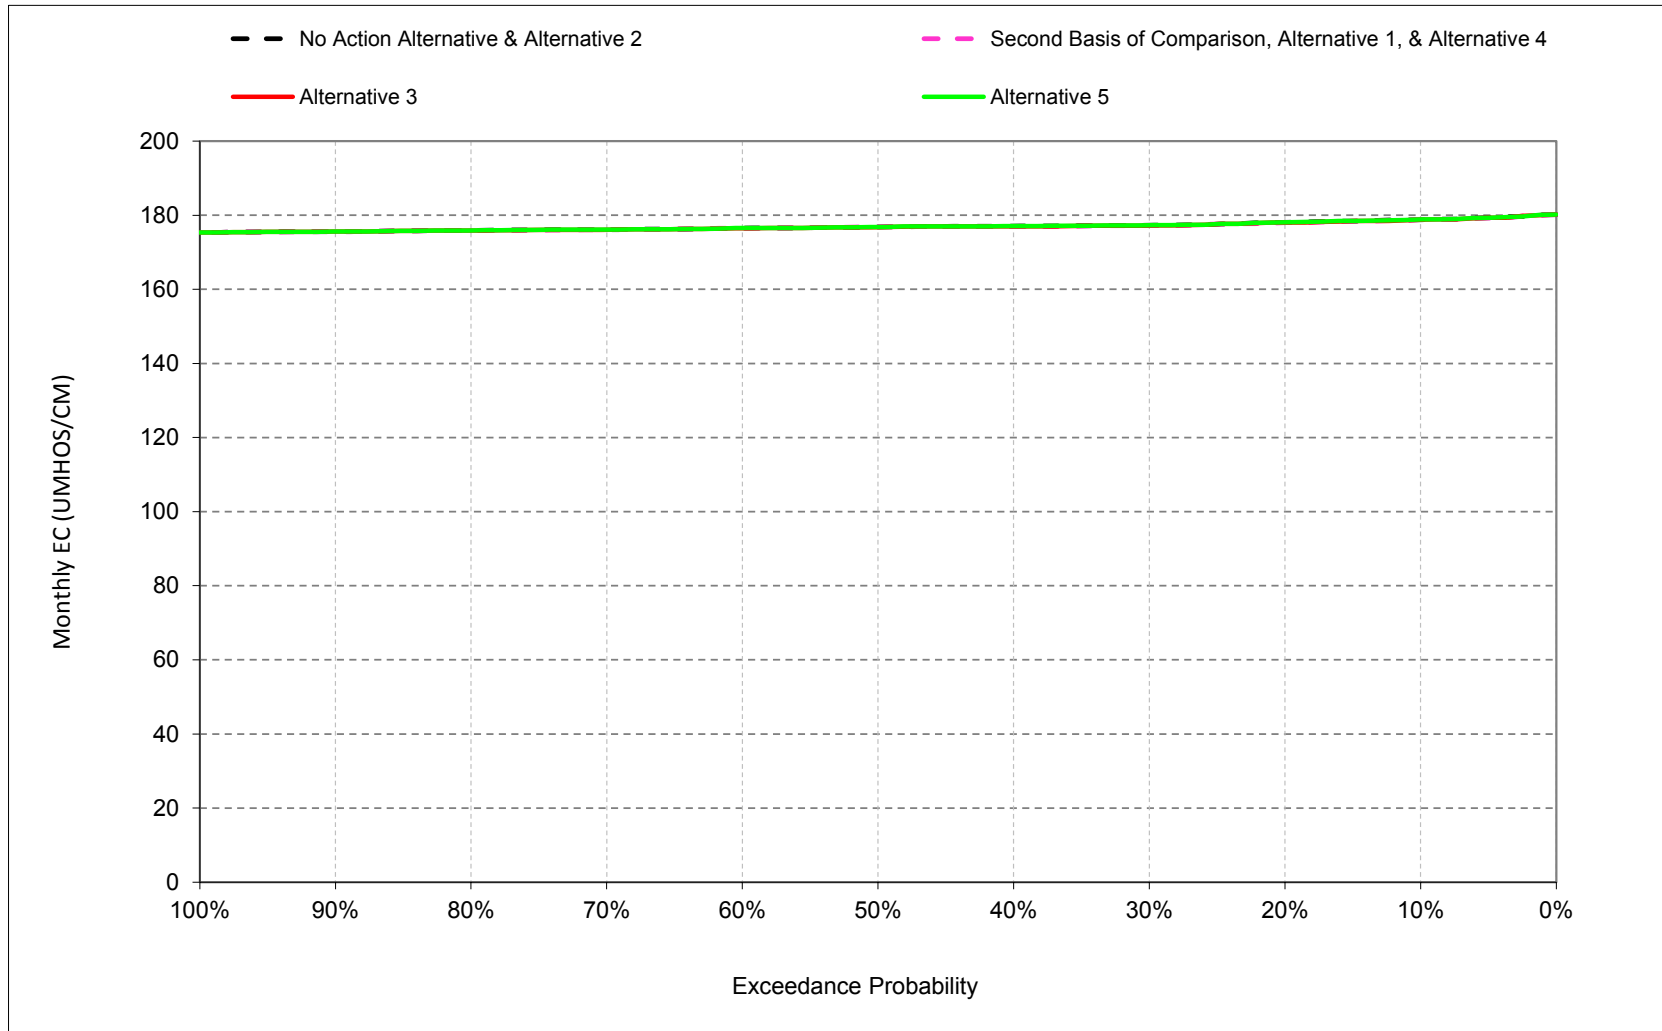


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.1.6. Sacramento River d/s of Steamboat Slough Salinity, Electrical Conductivity, March

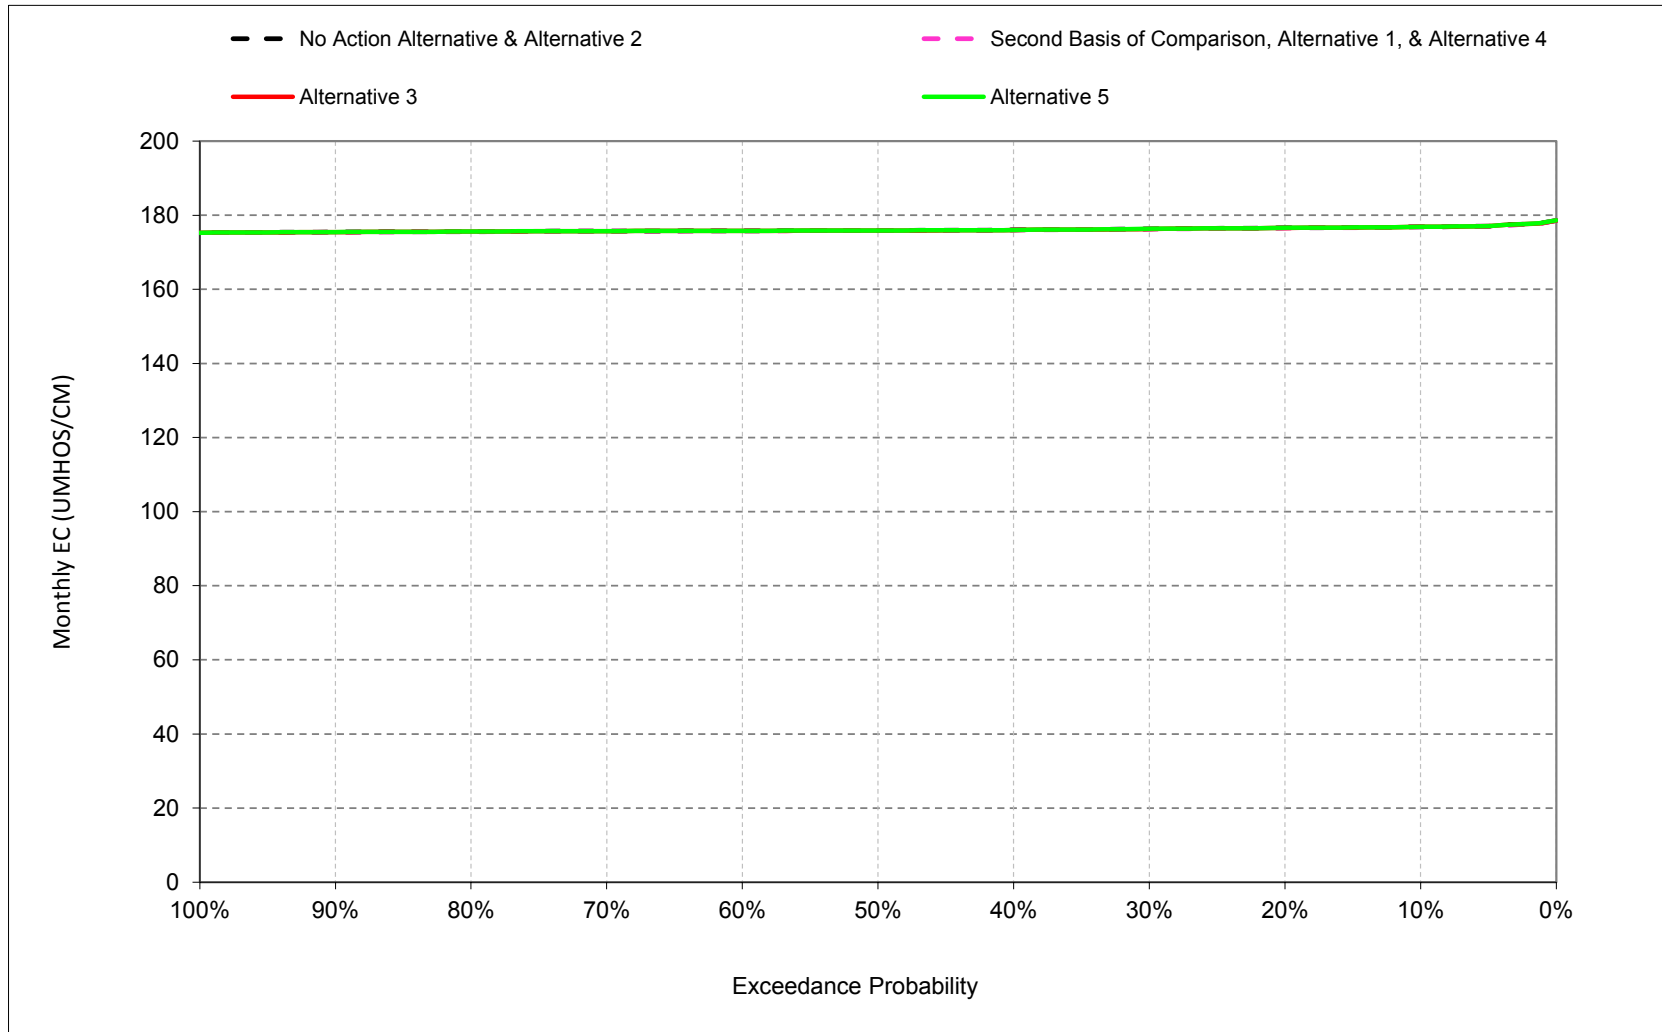


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.1.7. Sacramento River d/s of Steamboat Slough Salinity, Electrical Conductivity, April

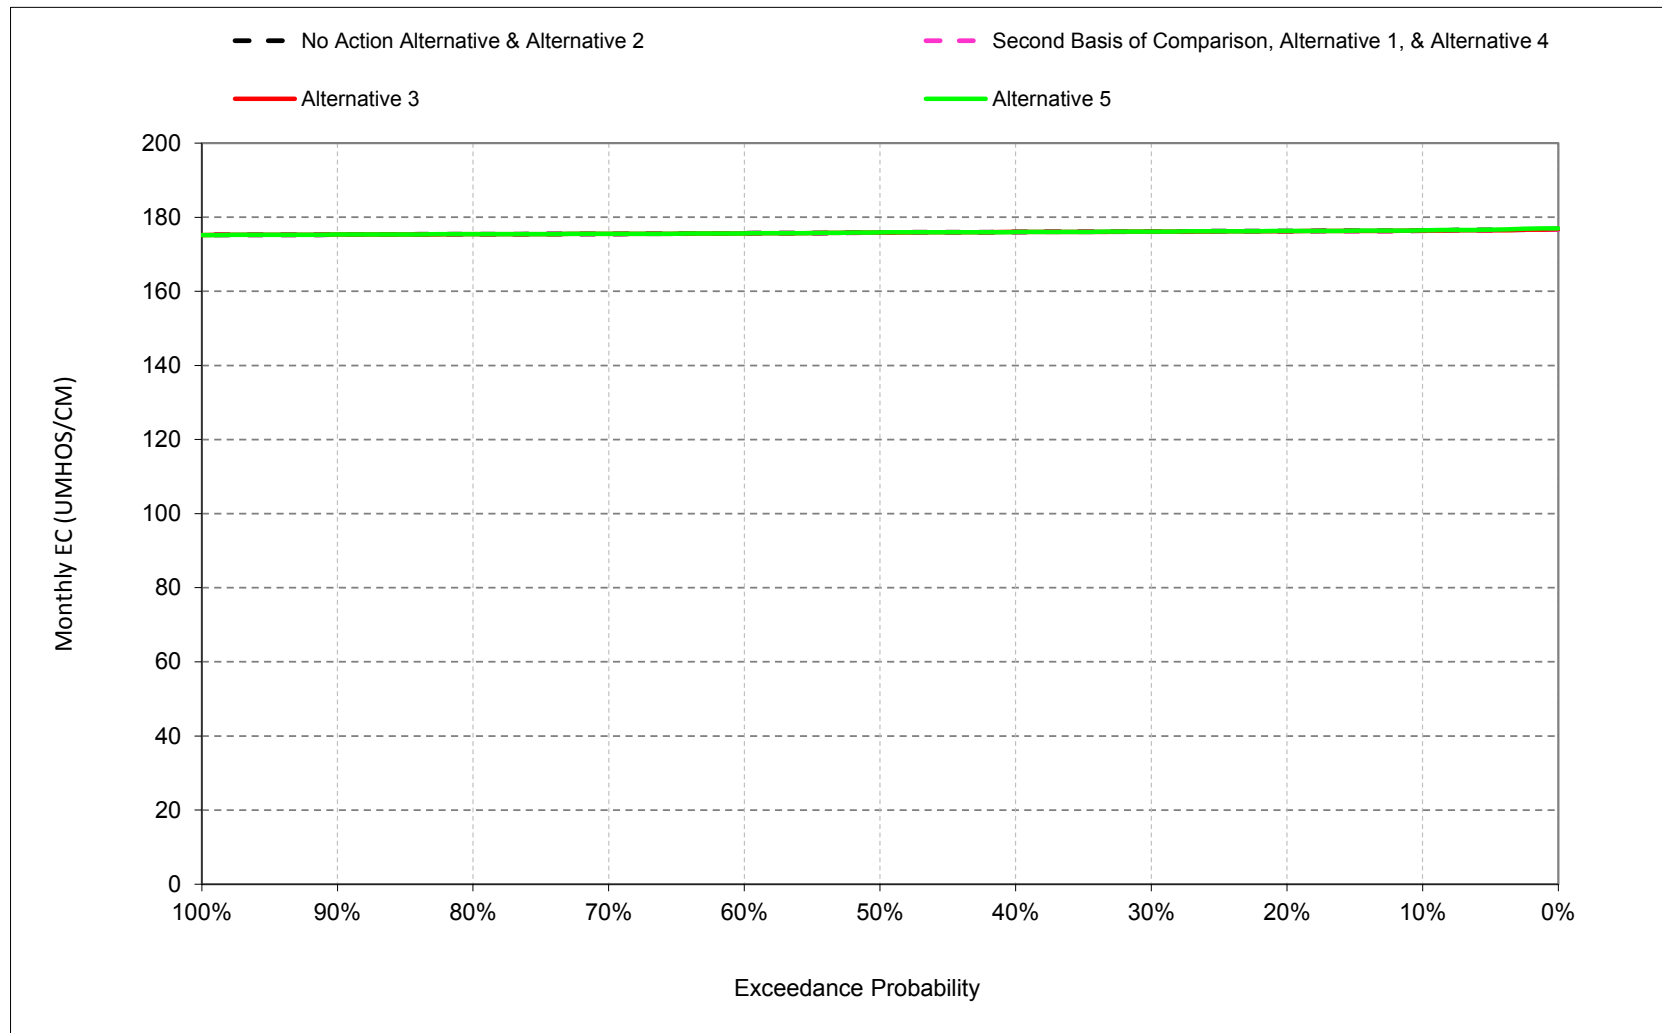


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.1.8. Sacramento River d/s of Steamboat Slough Salinity, Electrical Conductivity, May

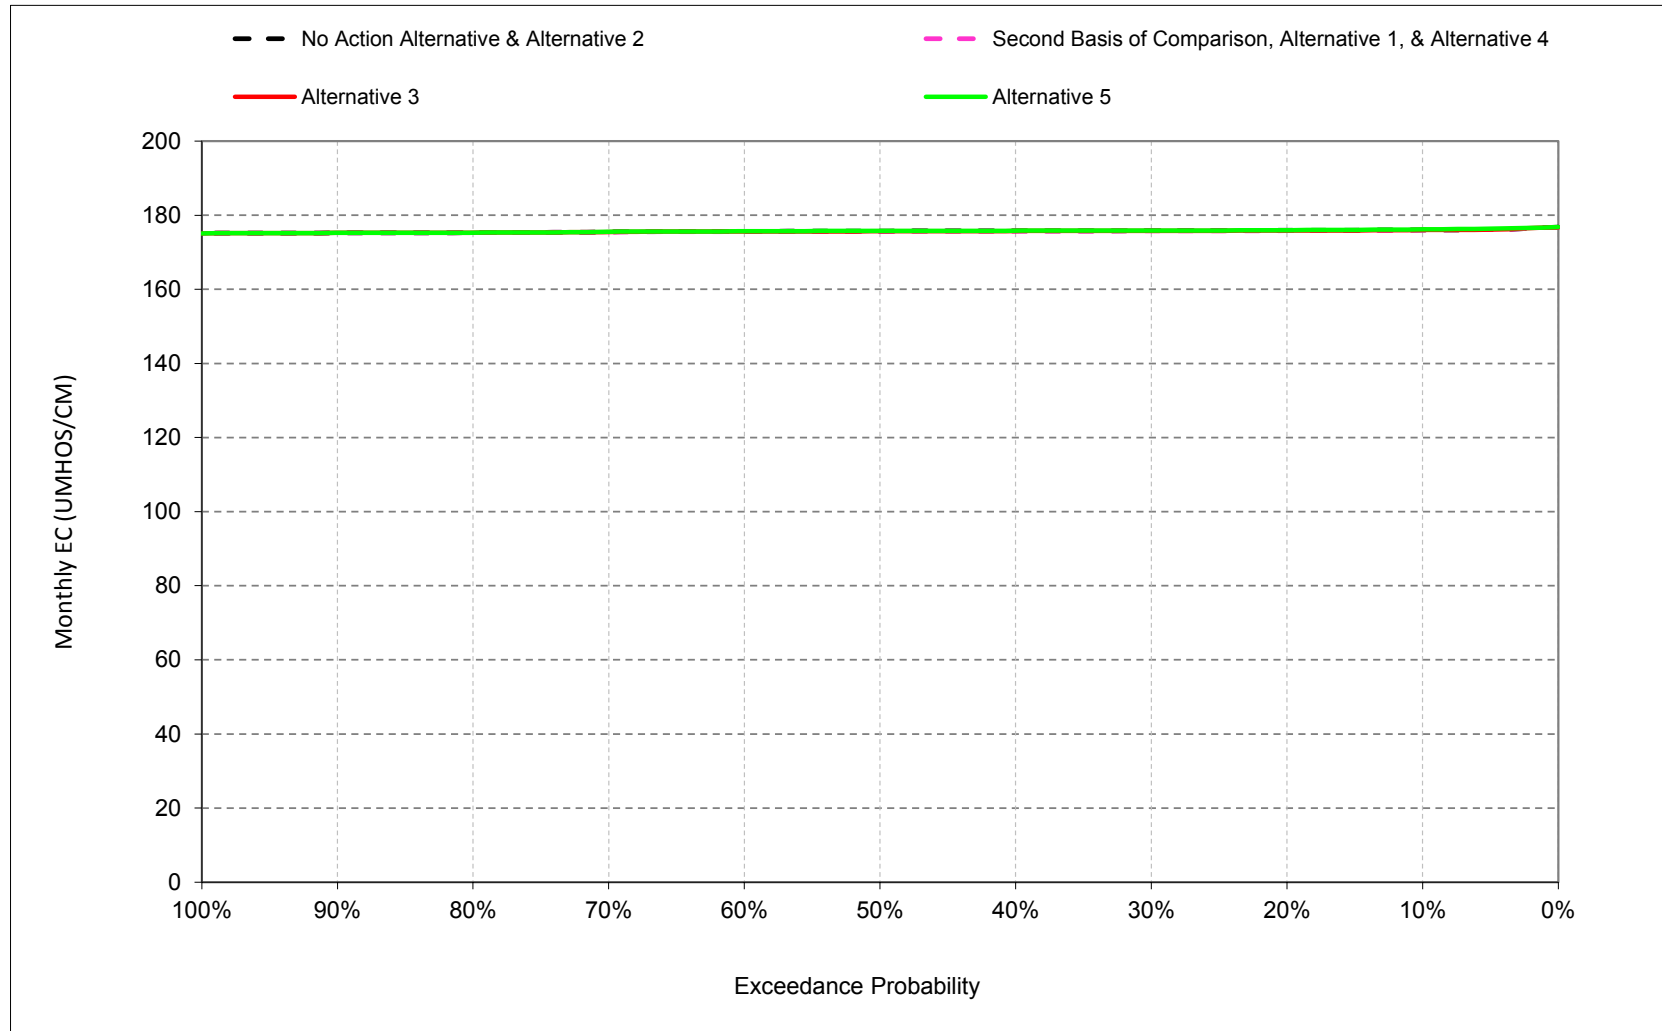


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.1.9. Sacramento River d/s of Steamboat Slough Salinity, Electrical Conductivity, June

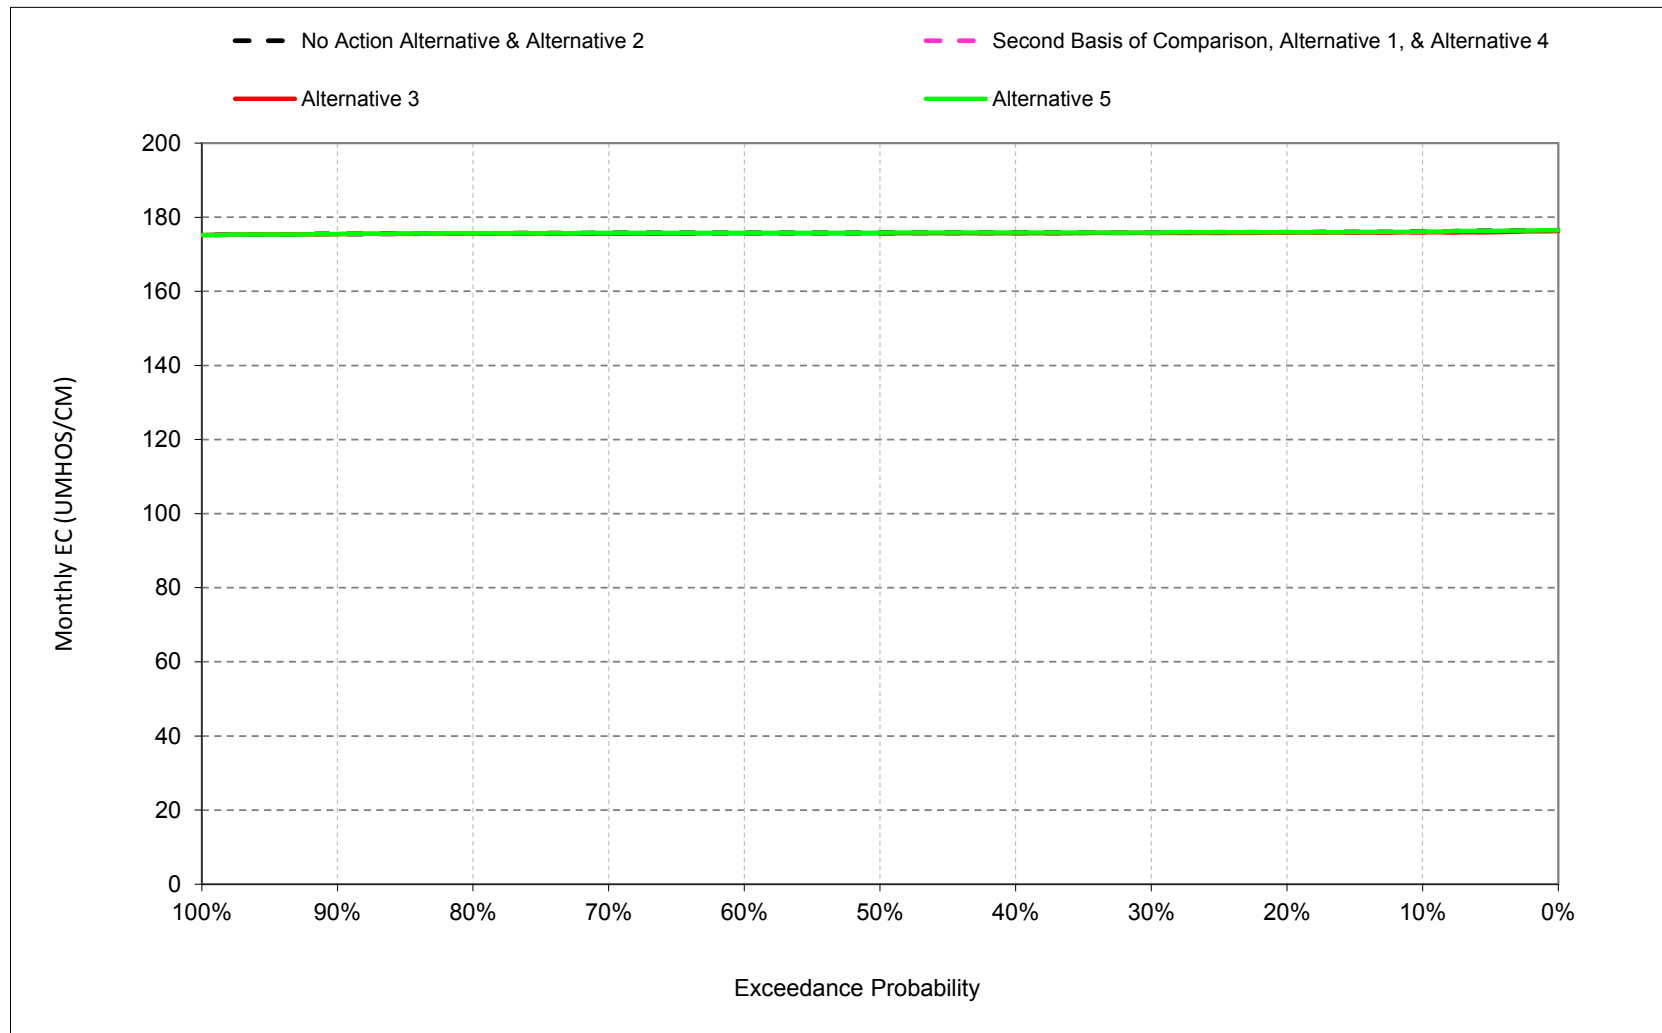


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.1.10. Sacramento River d/s of Steamboat Slough Salinity, Electrical Conductivity, July

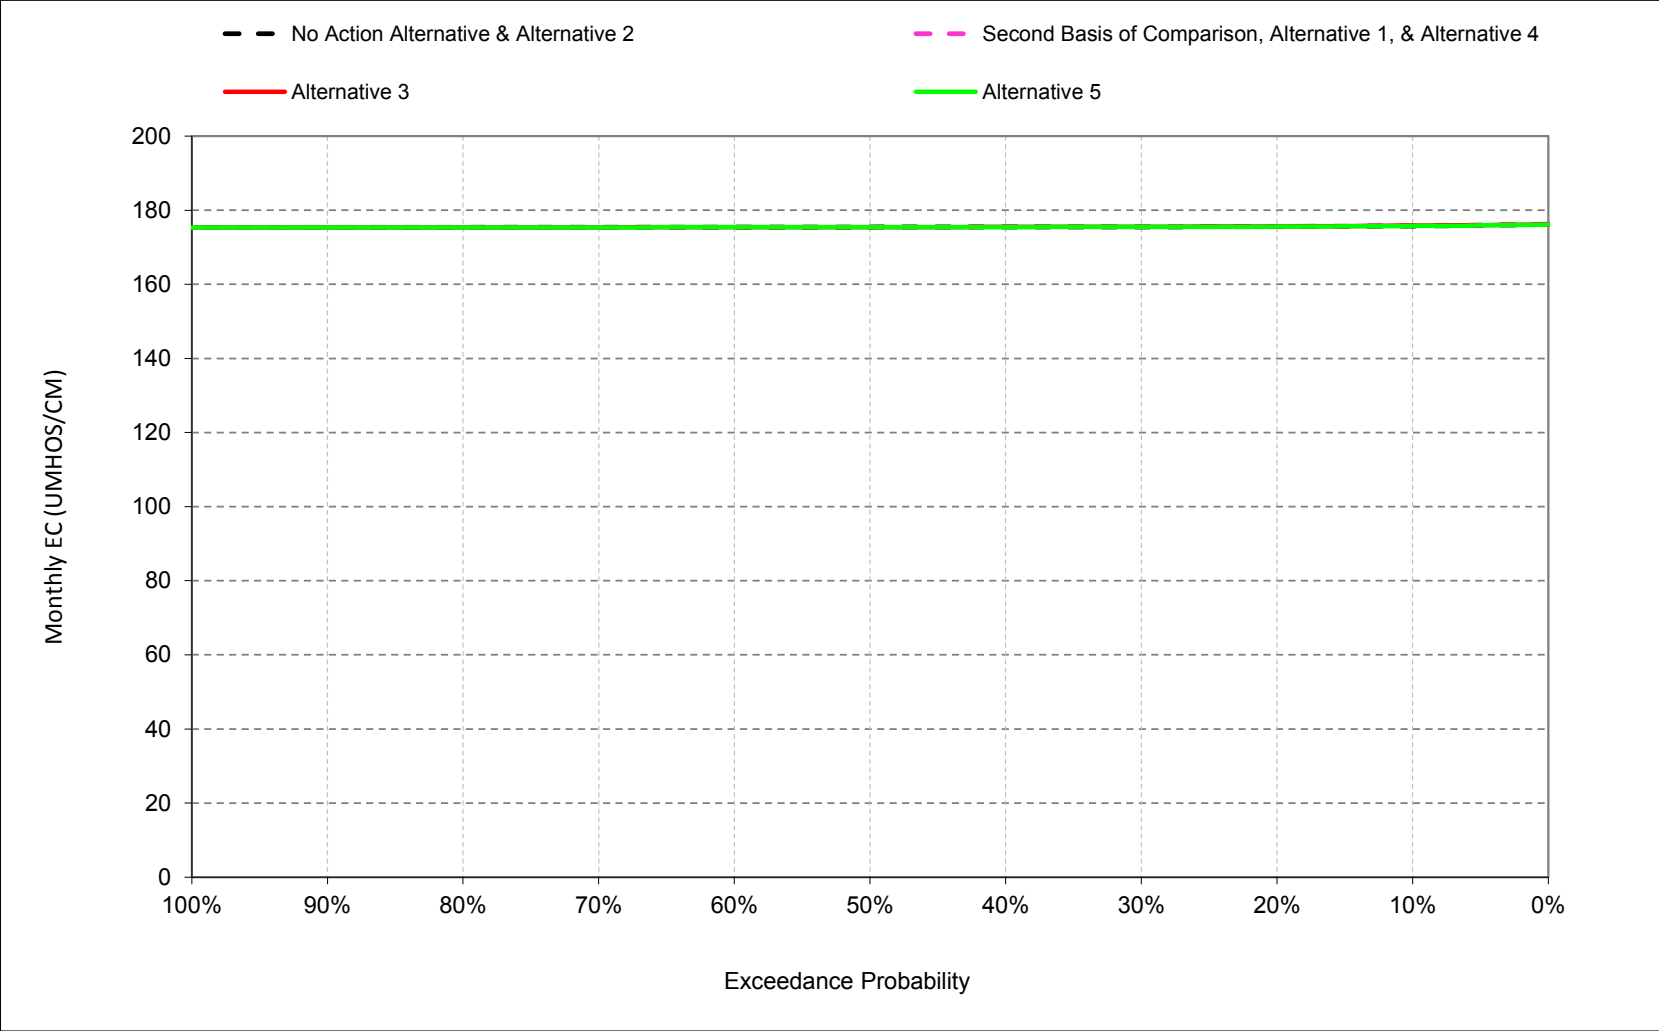


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.1.11. Sacramento River d/s of Steamboat Slough Salinity, Electrical Conductivity, August

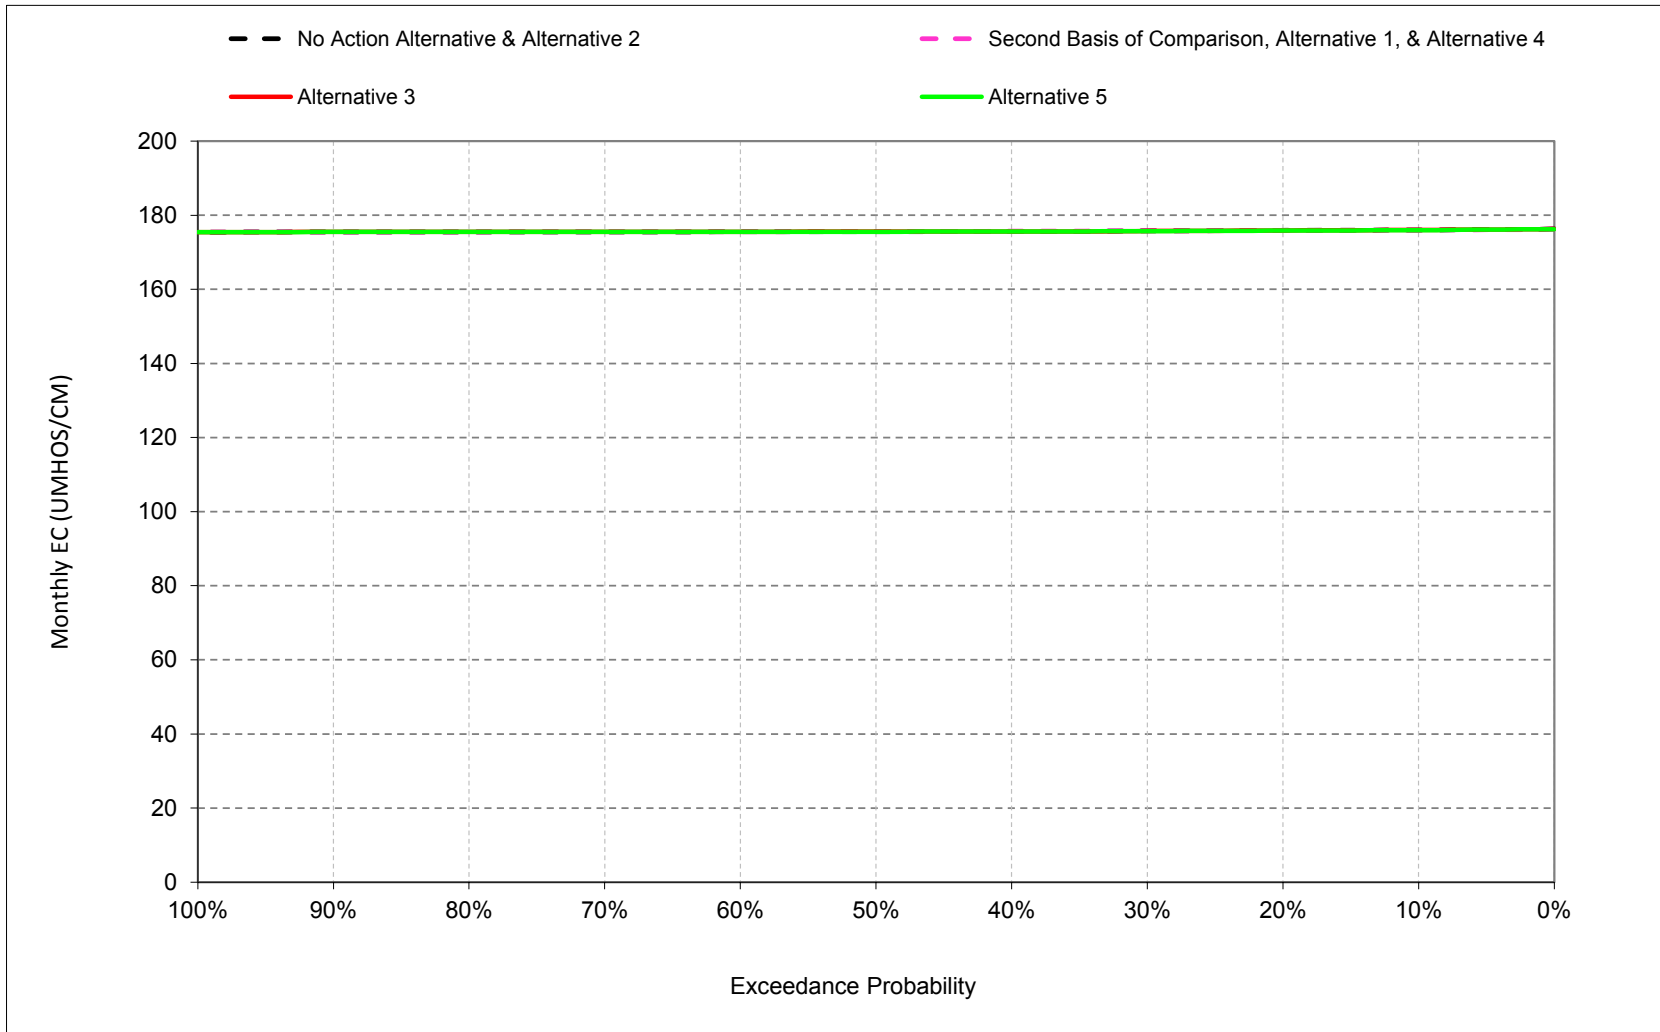

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.1.12. Sacramento River d/s of Steamboat Slough Salinity, Electrical Conductivity, September

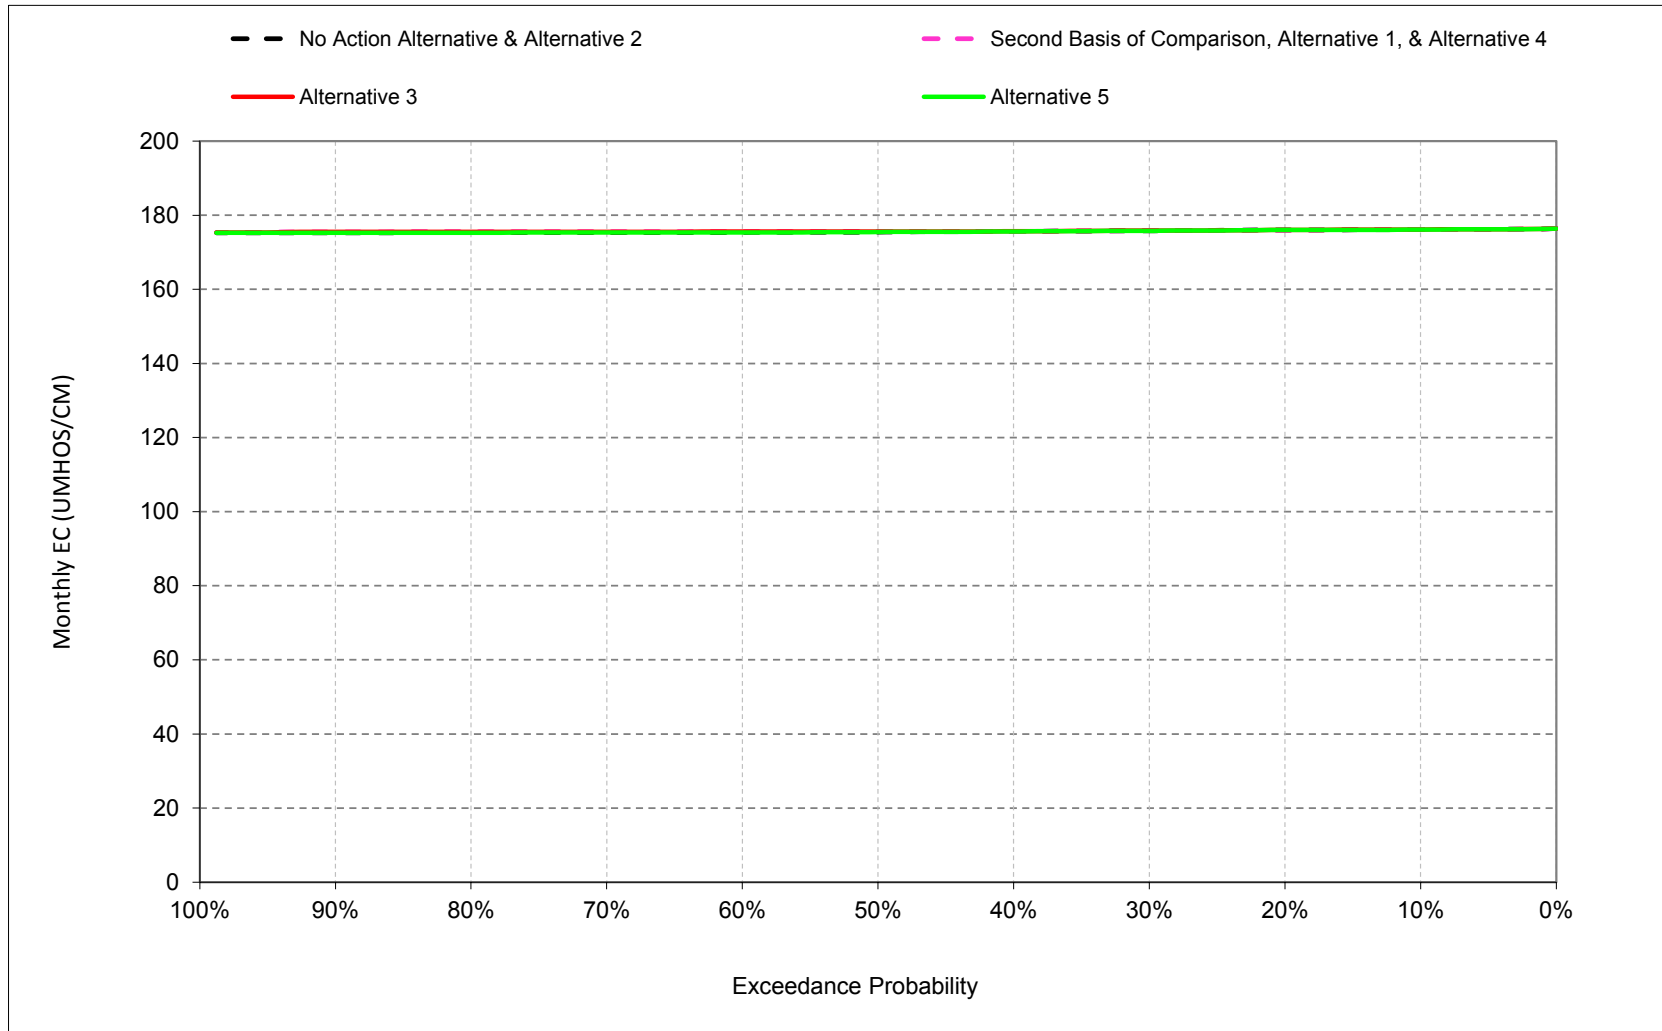

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.1.1. Sacramento River d/s of Steamboat Slough Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	176	177	178	181	179	177	176	176	176	176	176	176
20%	176	176	177	180	178	177	176	176	176	176	176	176
30%	176	176	177	179	177	176	176	176	176	175	176	176
40%	176	176	177	178	177	176	176	176	176	175	176	176
50%	176	176	176	178	177	176	176	176	176	175	176	175
60%	176	176	176	178	177	176	176	176	176	175	176	175
70%	175	175	176	177	176	176	175	176	176	175	176	175
80%	175	175	176	177	176	176	175	175	176	175	175	175
90%	175	175	175	177	176	175	175	175	175	175	175	175
Long Term												
Full Simulation Period ^b	176	176	177	178	177	176	176	176	176	175	176	176
Water Year Types ^c												
Wet (32%)	176	176	177	178	176	176	176	175	176	175	176	175
Above Normal (16%)	176	176	177	178	177	176	176	176	176	175	175	175
Below Normal (13%)	176	176	177	178	177	176	176	176	176	175	176	176
Dry (24%)	176	176	176	179	177	176	176	176	176	176	176	176
Critical (15%)	176	176	177	179	178	177	176	176	176	176	176	176

Alternative 1												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	176	177	178	181	179	177	176	176	176	176	176	176
20%	176	176	177	180	178	177	176	176	176	176	176	176
30%	176	176	177	179	177	176	176	176	176	176	176	176
40%	176	176	176	178	177	176	176	176	176	176	176	176
50%	176	176	176	178	177	176	176	176	176	175	176	176
60%	176	176	176	178	177	176	176	176	176	175	176	176
70%	175	176	176	177	176	176	175	176	176	175	176	176
80%	175	175	176	177	176	176	175	175	176	175	176	176
90%	175	175	175	177	176	175	175	175	175	175	175	176
Long Term												
Full Simulation Period ^b	176	176	177	178	177	176	176	176	176	176	176	176
Water Year Types ^c												
Wet (32%)	176	176	177	178	176	176	176	175	176	175	176	176
Above Normal (16%)	176	176	177	178	177	176	176	176	176	175	176	176
Below Normal (13%)	176	176	177	178	177	176	176	176	176	175	176	176
Dry (24%)	176	176	176	179	177	176	176	176	176	176	176	176
Critical (15%)	176	176	177	178	178	177	176	176	176	176	176	176

Alternative 1 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types ^c												
Wet (32%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (13%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (15%)	0	0	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.1.2. Sacramento River d/s of Steamboat Slough Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	176	177	178	181	179	177	176	176	176	176	176	176
20%	176	176	177	180	178	177	176	176	176	176	176	176
30%	176	176	177	179	177	176	176	176	176	175	176	176
40%	176	176	177	178	177	176	176	176	176	175	176	176
50%	176	176	176	178	177	176	176	176	176	175	176	175
60%	176	176	176	178	177	176	176	176	176	175	176	175
70%	175	175	176	177	176	176	175	176	176	175	176	175
80%	175	175	176	177	176	176	175	175	176	175	175	175
90%	175	175	175	177	176	175	175	175	175	175	175	175
Long Term												
Full Simulation Period ^b	176	176	177	178	177	176	176	176	176	175	176	176
Water Year Types^c												
Wet (32%)	176	176	177	178	176	176	176	175	176	175	176	175
Above Normal (16%)	176	176	177	178	177	176	176	176	176	175	175	175
Below Normal (13%)	176	176	177	178	177	176	176	176	176	175	176	176
Dry (24%)	176	176	176	179	177	176	176	176	176	176	176	176
Critical (15%)	176	176	177	179	178	177	176	176	176	176	176	176

Alternative 3												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	176	177	178	181	179	177	176	176	176	176	176	176
20%	176	176	177	180	178	177	176	176	176	176	176	176
30%	176	176	177	179	177	176	176	176	176	176	176	176
40%	176	176	176	178	177	176	176	176	176	175	176	176
50%	176	176	176	178	177	176	176	176	176	175	176	176
60%	176	176	176	178	177	176	176	176	176	175	176	176
70%	176	175	176	177	176	176	175	175	176	175	176	176
80%	175	175	176	177	176	176	175	175	176	175	176	176
90%	175	175	175	177	176	175	175	175	175	175	175	175
Long Term												
Full Simulation Period ^b	176	176	177	178	177	176	176	176	176	176	176	176
Water Year Types^c												
Wet (32%)	176	176	177	178	176	176	176	175	176	175	176	176
Above Normal (16%)	176	176	177	178	177	176	176	176	176	175	176	176
Below Normal (13%)	176	176	177	178	177	176	176	176	176	175	176	176
Dry (24%)	176	176	176	179	177	176	176	176	176	176	176	176
Critical (15%)	176	176	177	179	178	177	176	176	176	176	176	176

Alternative 3 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types^c												
Wet (32%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (13%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (15%)	0	0	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.1.3. Sacramento River d/s of Steamboat Slough Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	176	177	178	181	179	177	176	176	176	176	176	176
20%	176	176	177	180	178	177	176	176	176	176	176	176
30%	176	176	177	179	177	176	176	176	176	175	176	176
40%	176	176	177	178	177	176	176	176	176	175	176	176
50%	176	176	176	178	177	176	176	176	176	175	176	175
60%	176	176	176	178	177	176	176	176	176	175	176	175
70%	175	175	176	177	176	176	175	176	176	175	176	175
80%	175	175	176	177	176	176	175	175	176	175	175	175
90%	175	175	175	177	176	175	175	175	175	175	175	175
Long Term												
Full Simulation Period ^b	176	176	177	178	177	176	176	176	176	175	176	176
Water Year Types^c												
Wet (32%)	176	176	177	178	176	176	176	175	176	175	176	175
Above Normal (16%)	176	176	177	178	177	176	176	176	176	175	175	175
Below Normal (13%)	176	176	177	178	177	176	176	176	176	175	176	176
Dry (24%)	176	176	176	179	177	176	176	176	176	176	176	176
Critical (15%)	176	176	177	179	178	177	176	176	176	176	176	176

Alternative 5												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	176	177	178	181	179	177	176	176	176	176	176	176
20%	176	176	177	180	178	177	176	176	176	176	176	176
30%	176	176	177	179	177	176	176	176	176	175	176	176
40%	176	176	177	178	177	176	176	176	176	175	176	176
50%	176	176	176	178	177	176	176	176	176	175	176	175
60%	176	176	176	178	177	176	176	176	176	175	176	175
70%	175	175	176	177	176	176	175	176	176	175	176	175
80%	175	175	176	177	176	176	175	175	176	175	175	175
90%	175	175	175	177	176	175	175	175	175	175	175	175
Long Term												
Full Simulation Period ^b	176	176	177	178	177	176	176	176	176	175	176	176
Water Year Types^c												
Wet (32%)	176	176	177	178	176	176	176	175	176	175	176	175
Above Normal (16%)	176	176	177	178	177	176	176	176	176	175	175	175
Below Normal (13%)	176	176	177	178	177	176	176	176	176	175	176	176
Dry (24%)	176	176	176	179	177	176	176	176	176	176	176	176
Critical (15%)	176	176	177	179	178	177	176	176	176	176	176	176

Alternative 5 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types^c												
Wet (32%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (13%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (15%)	0	0	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.1.4. Sacramento River d/s of Steamboat Slough Salinity, Monthly EC

Second Basis of Comparison

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	176	177	178	181	179	177	176	176	176	176	176	176
20%	176	176	177	180	178	177	176	176	176	176	176	176
30%	176	176	177	179	177	176	176	176	176	176	176	176
40%	176	176	176	178	177	176	176	176	176	176	176	176
50%	176	176	176	178	177	176	176	176	176	176	175	176
60%	176	176	176	178	177	176	176	176	176	176	175	176
70%	175	176	176	177	176	176	175	176	176	175	176	176
80%	175	175	176	177	176	176	175	175	176	175	176	176
90%	175	175	175	177	176	175	175	175	175	175	175	176
Long Term												
Full Simulation Period ^b	176	176	177	178	177	176	176	176	176	176	176	176
Water Year Types^c												
Wet (32%)	176	176	177	178	176	176	176	175	176	175	176	176
Above Normal (16%)	176	176	177	178	177	176	176	176	176	175	176	176
Below Normal (13%)	176	176	177	178	177	176	176	176	176	175	176	176
Dry (24%)	176	176	176	179	177	176	176	176	176	176	176	176
Critical (15%)	176	176	177	178	178	177	176	176	176	176	176	176

No Action Alternative

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	176	177	178	181	179	177	176	176	176	176	176	176
20%	176	176	177	180	178	177	176	176	176	176	176	176
30%	176	176	177	179	177	176	176	176	176	175	176	176
40%	176	176	177	178	177	176	176	176	176	175	176	176
50%	176	176	176	178	177	176	176	176	176	175	176	175
60%	176	176	176	178	177	176	176	176	176	175	176	175
70%	175	175	176	177	176	176	175	176	176	175	176	175
80%	175	175	176	177	176	176	175	175	176	175	175	175
90%	175	175	175	177	176	175	175	175	175	175	175	175
Long Term												
Full Simulation Period ^b	176	176	177	178	177	176	176	176	176	175	176	176
Water Year Types^c												
Wet (32%)	176	176	177	178	176	176	176	175	176	175	176	175
Above Normal (16%)	176	176	177	178	177	176	176	176	176	175	175	175
Below Normal (13%)	176	176	177	178	177	176	176	176	176	175	176	176
Dry (24%)	176	176	176	179	177	176	176	176	176	176	176	176
Critical (15%)	176	176	177	179	178	177	176	176	176	176	176	176

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types^c												
Wet (32%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (13%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (15%)	0	0	0	0	0	0	0	0	0	0	0	0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.1.5. Sacramento River d/s of Steamboat Slough Salinity, Monthly EC

Second Basis of Comparison												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	176	177	178	181	179	177	176	176	176	176	176	176
20%	176	176	177	180	178	177	176	176	176	176	176	176
30%	176	176	177	179	177	176	176	176	176	176	176	176
40%	176	176	176	178	177	176	176	176	176	176	176	176
50%	176	176	176	178	177	176	176	176	176	176	175	176
60%	176	176	176	178	177	176	176	176	176	176	175	176
70%	175	176	176	177	176	176	175	176	176	175	176	176
80%	175	175	176	177	176	176	175	175	176	175	176	176
90%	175	175	175	177	176	175	175	175	175	175	175	176
Long Term												
Full Simulation Period ^b	176	176	177	178	177	176	176	176	176	176	176	176
Water Year Types^c												
Wet (32%)	176	176	177	178	176	176	176	175	176	175	176	176
Above Normal (16%)	176	176	177	178	177	176	176	176	176	175	176	176
Below Normal (13%)	176	176	177	178	177	176	176	176	176	175	176	176
Dry (24%)	176	176	176	179	177	176	176	176	176	176	176	176
Critical (15%)	176	176	177	178	178	177	176	176	176	176	176	176

Alternative 3												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	176	177	178	181	179	177	176	176	176	176	176	176
20%	176	176	177	180	178	177	176	176	176	176	176	176
30%	176	176	177	179	177	176	176	176	176	176	176	176
40%	176	176	176	178	177	176	176	176	176	176	175	176
50%	176	176	176	178	177	176	176	176	176	176	175	176
60%	176	176	176	178	177	176	176	176	176	176	175	176
70%	176	175	176	177	176	176	175	175	176	175	176	176
80%	175	175	176	177	176	176	175	175	176	175	176	176
90%	175	175	175	177	176	175	175	175	175	175	175	175
Long Term												
Full Simulation Period ^b	176	176	177	178	177	176	176	176	176	176	176	176
Water Year Types^c												
Wet (32%)	176	176	177	178	176	176	176	175	176	175	176	176
Above Normal (16%)	176	176	177	178	177	176	176	176	176	175	176	176
Below Normal (13%)	176	176	177	178	177	176	176	176	176	175	176	176
Dry (24%)	176	176	176	179	177	176	176	176	176	176	176	176
Critical (15%)	176	176	177	179	178	177	176	176	176	176	176	176

Alternative 3 minus Second Basis of Comparison												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types^c												
Wet (32%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (13%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (15%)	0	0	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.1.6. Sacramento River d/s of Steamboat Slough Salinity, Monthly EC

Second Basis of Comparison

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	176	177	178	181	179	177	176	176	176	176	176	176
20%	176	176	177	180	178	177	176	176	176	176	176	176
30%	176	176	177	179	177	176	176	176	176	176	176	176
40%	176	176	176	178	177	176	176	176	176	176	176	176
50%	176	176	176	178	177	176	176	176	176	176	175	176
60%	176	176	176	178	177	176	176	176	176	176	175	176
70%	175	176	176	177	176	176	175	176	176	175	176	176
80%	175	175	176	177	176	176	175	175	176	175	176	176
90%	175	175	175	177	176	175	175	175	175	175	175	176
Long Term												
Full Simulation Period ^b	176	176	177	178	177	176	176	176	176	176	176	176
Water Year Types ^c												
Wet (32%)	176	176	177	178	176	176	176	175	176	175	176	176
Above Normal (16%)	176	176	177	178	177	176	176	176	176	175	176	176
Below Normal (13%)	176	176	177	178	177	176	176	176	176	175	176	176
Dry (24%)	176	176	176	179	177	176	176	176	176	176	176	176
Critical (15%)	176	176	177	178	178	177	176	176	176	176	176	176

Alternative 5

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	176	177	178	181	179	177	176	176	176	176	176	176
20%	176	176	177	180	178	177	176	176	176	176	176	176
30%	176	176	177	179	177	176	176	176	176	175	176	176
40%	176	176	177	178	177	176	176	176	176	175	176	176
50%	176	176	176	178	177	176	176	176	176	175	176	175
60%	176	176	176	178	177	176	176	176	176	175	176	175
70%	175	175	176	177	176	176	175	176	176	175	176	175
80%	175	175	176	177	176	176	175	175	176	175	175	175
90%	175	175	175	177	176	175	175	175	175	175	175	175
Long Term												
Full Simulation Period ^b	176	176	177	178	177	176	176	176	176	175	176	176
Water Year Types ^c												
Wet (32%)	176	176	177	178	176	176	176	175	176	175	176	175
Above Normal (16%)	176	176	177	178	177	176	176	176	176	175	175	175
Below Normal (13%)	176	176	177	178	177	176	176	176	176	175	176	176
Dry (24%)	176	176	176	179	177	176	176	176	176	175	176	176
Critical (15%)	176	176	177	179	178	177	176	176	176	176	176	176

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0	0	0	0	0	0	0	0	0	0	0	0
20%	0	0	0	0	0	0	0	0	0	0	0	0
30%	0	0	0	0	0	0	0	0	0	0	0	0
40%	0	0	0	0	0	0	0	0	0	0	0	0
50%	0	0	0	0	0	0	0	0	0	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	0	0	0	0	0	0	0	0	0
80%	0	0	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	0	0	0	0	0
Water Year Types ^c												
Wet (32%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (13%)	0	0	0	0	0	0	0	0	0	0	0	0
Dry (24%)	0	0	0	0	0	0	0	0	0	0	0	0
Critical (15%)	0	0	0	0	0	0	0	0	0	0	0	0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 **B.2. Sacramento River at Emmaton Salinity**

Figure 6E.B.2.1. Sacramento River at Emmaton Salinity, Electrical Conductivity, October

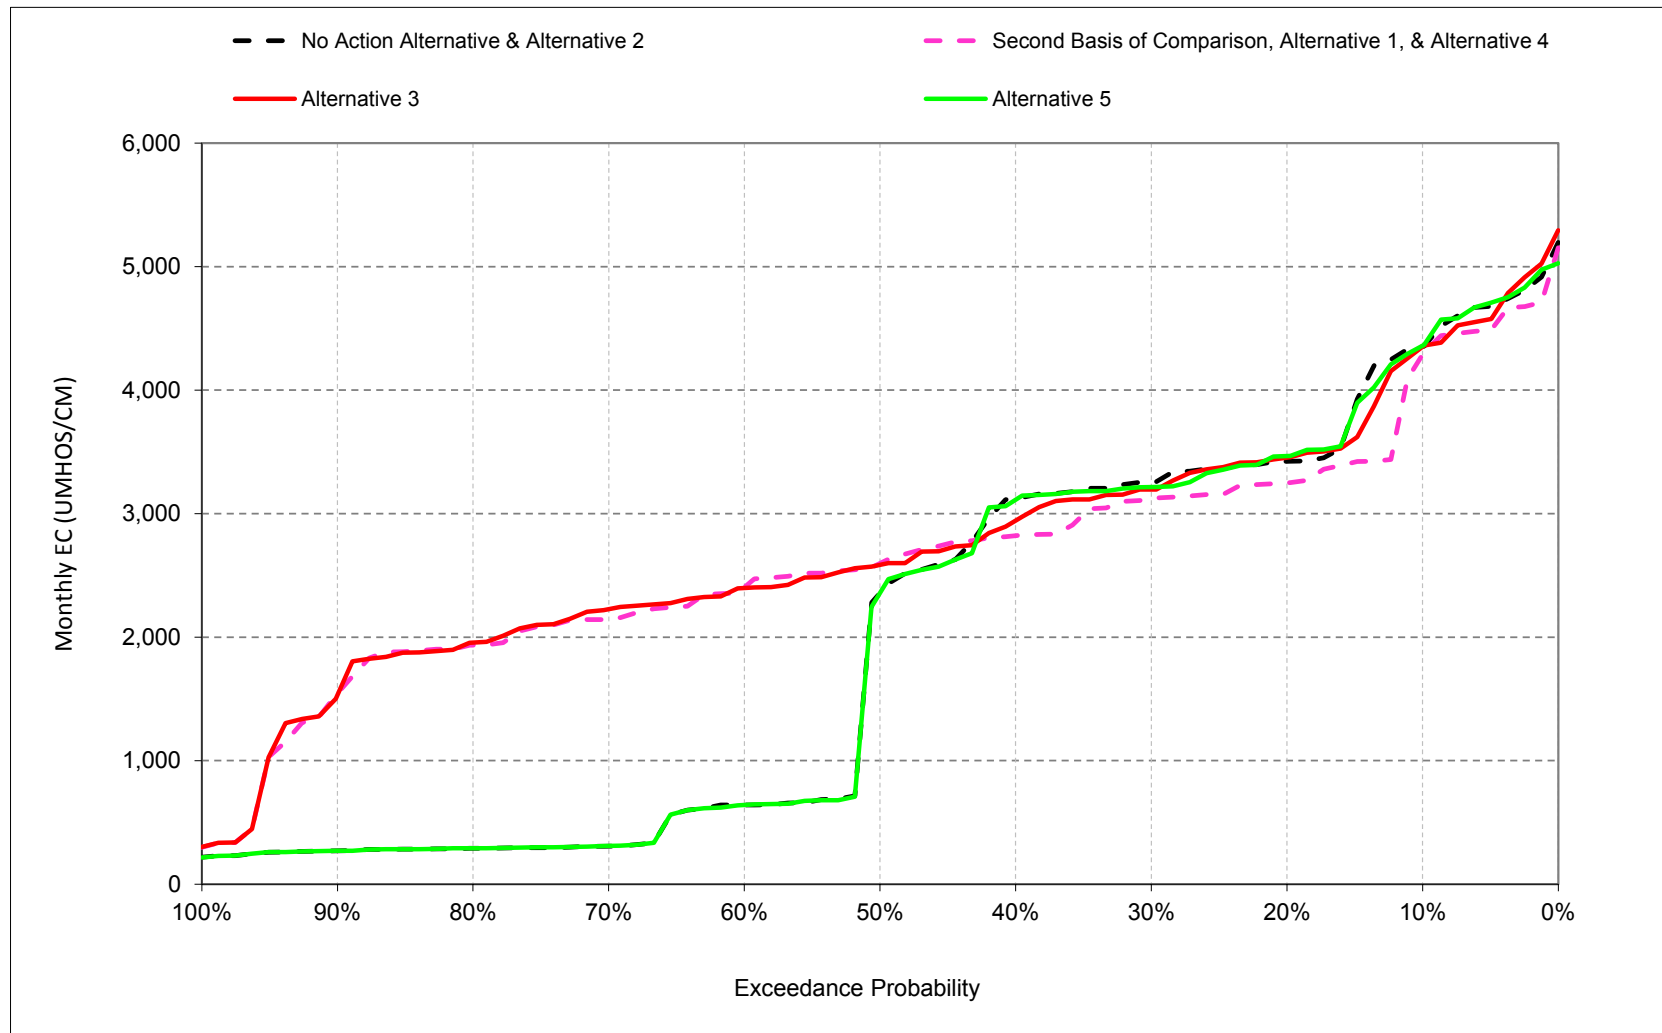


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.2.2. Sacramento River at Emmaton Salinity, Electrical Conductivity, November

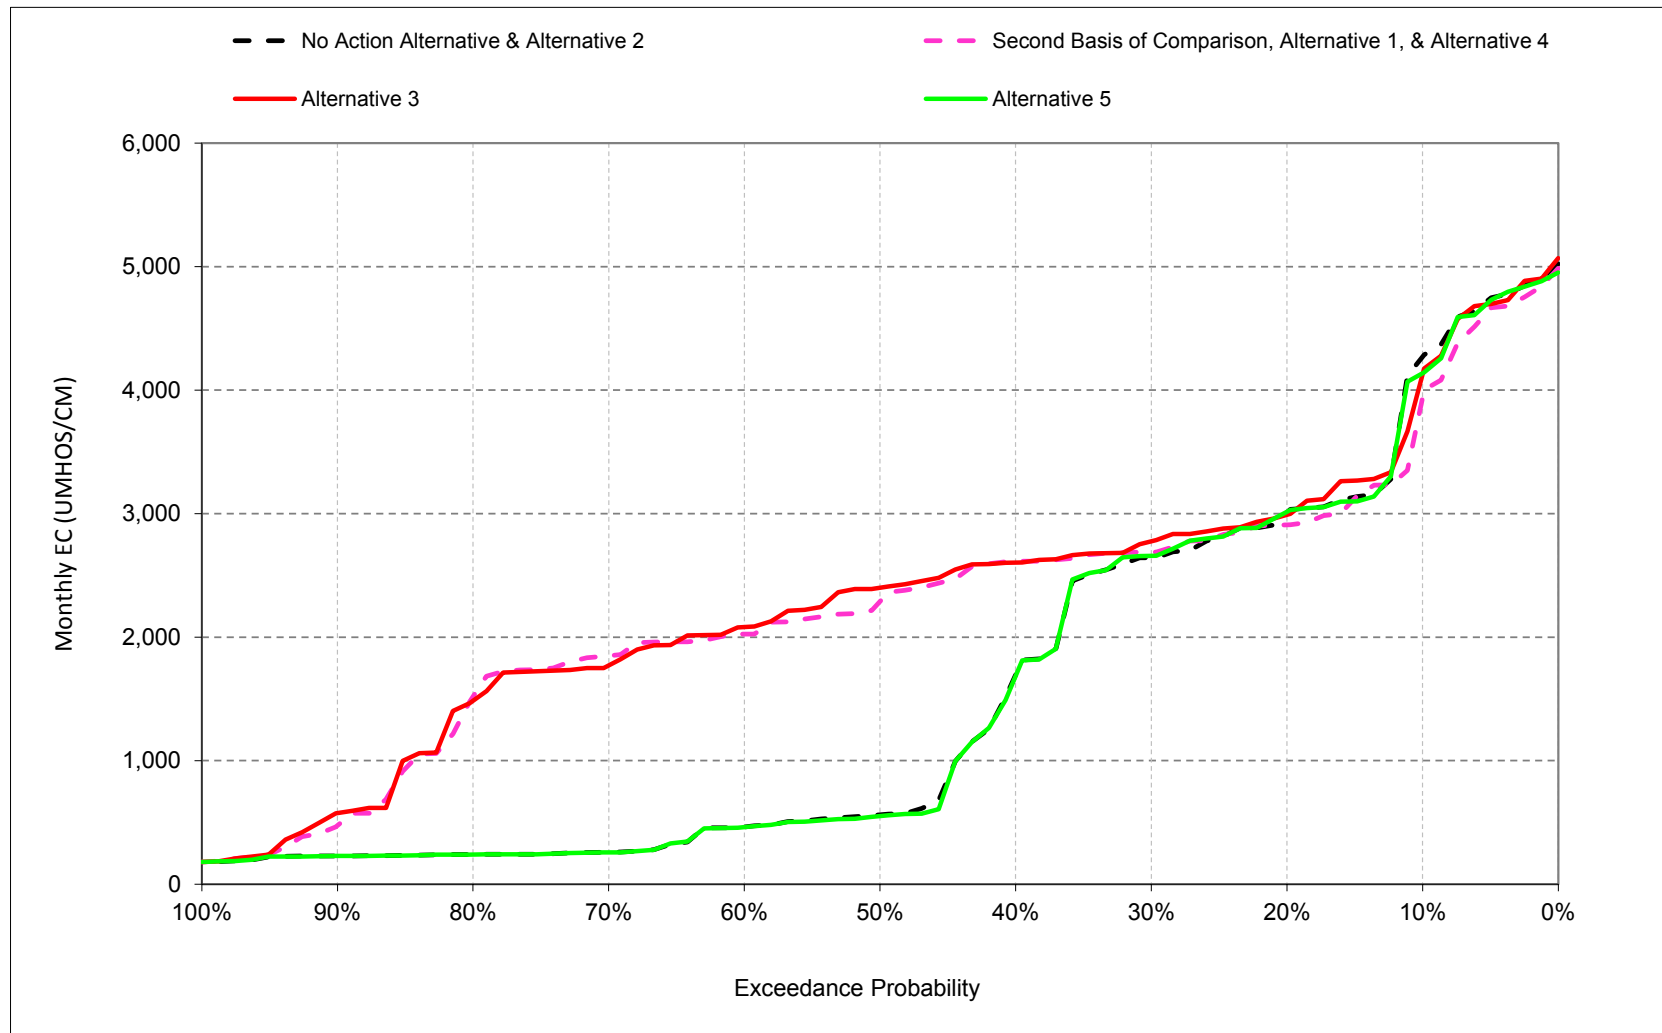


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.2.3. Sacramento River at Emmaton Salinity, Electrical Conductivity, December

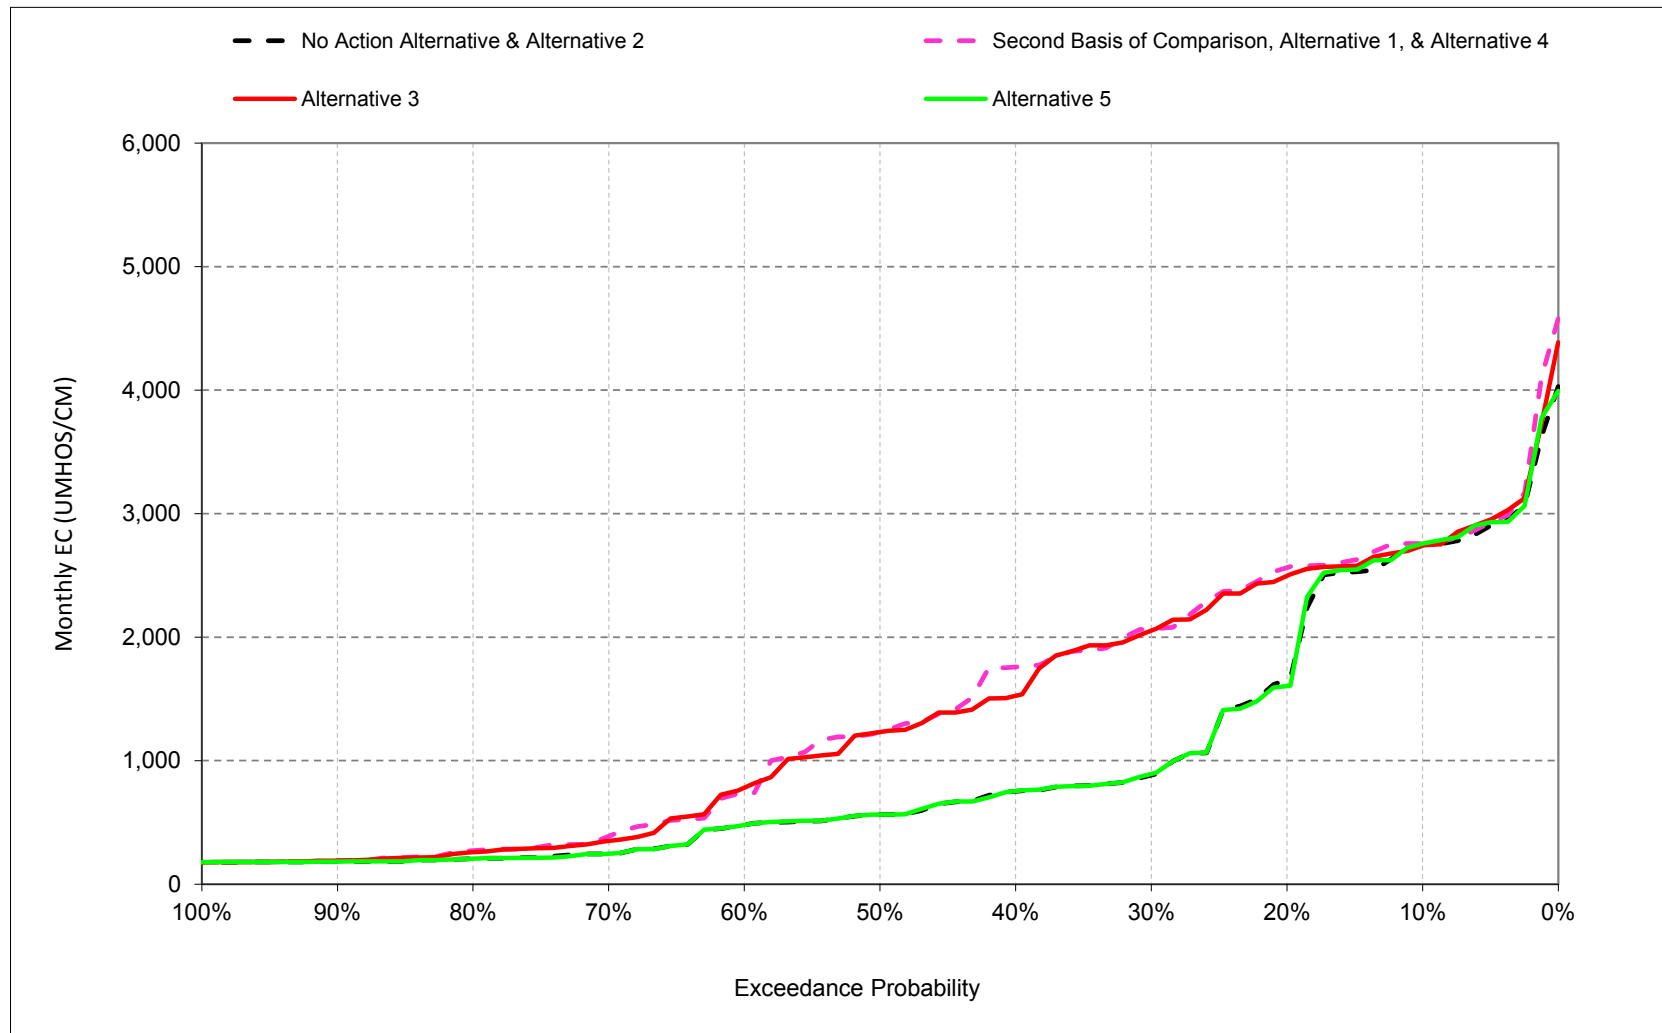


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.2.4. Sacramento River at Emmaton Salinity, Electrical Conductivity, January

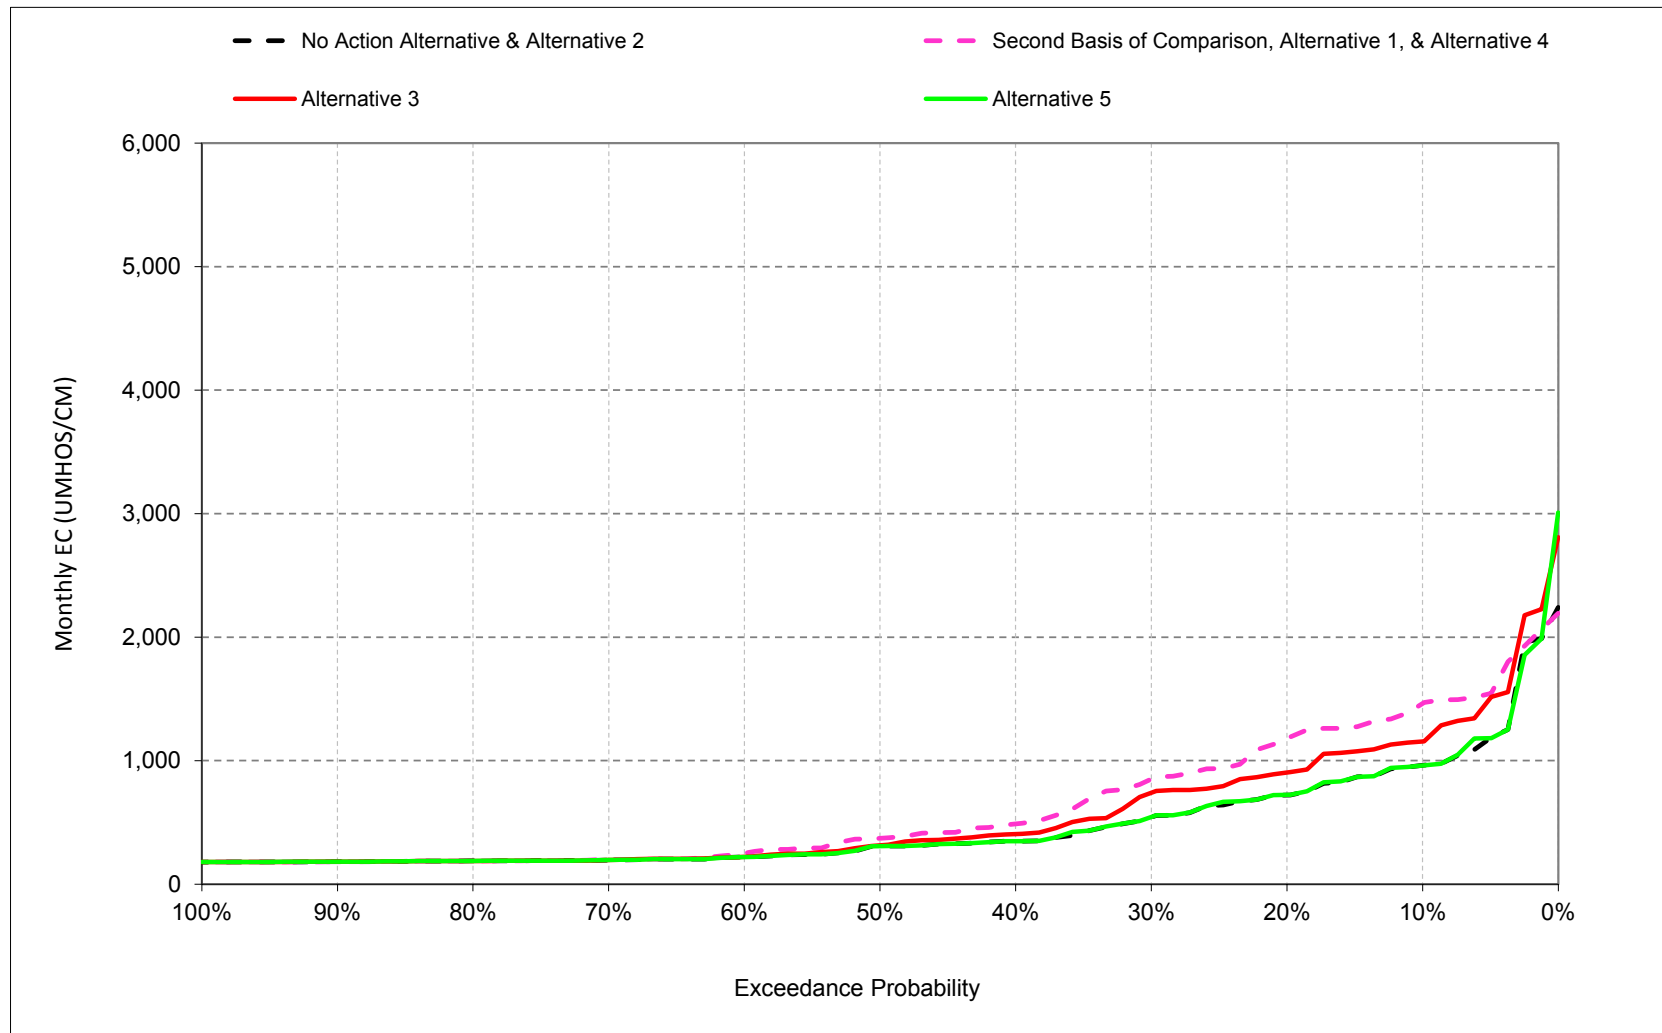


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.2.5. Sacramento River at Emmaton Salinity, Electrical Conductivity, February

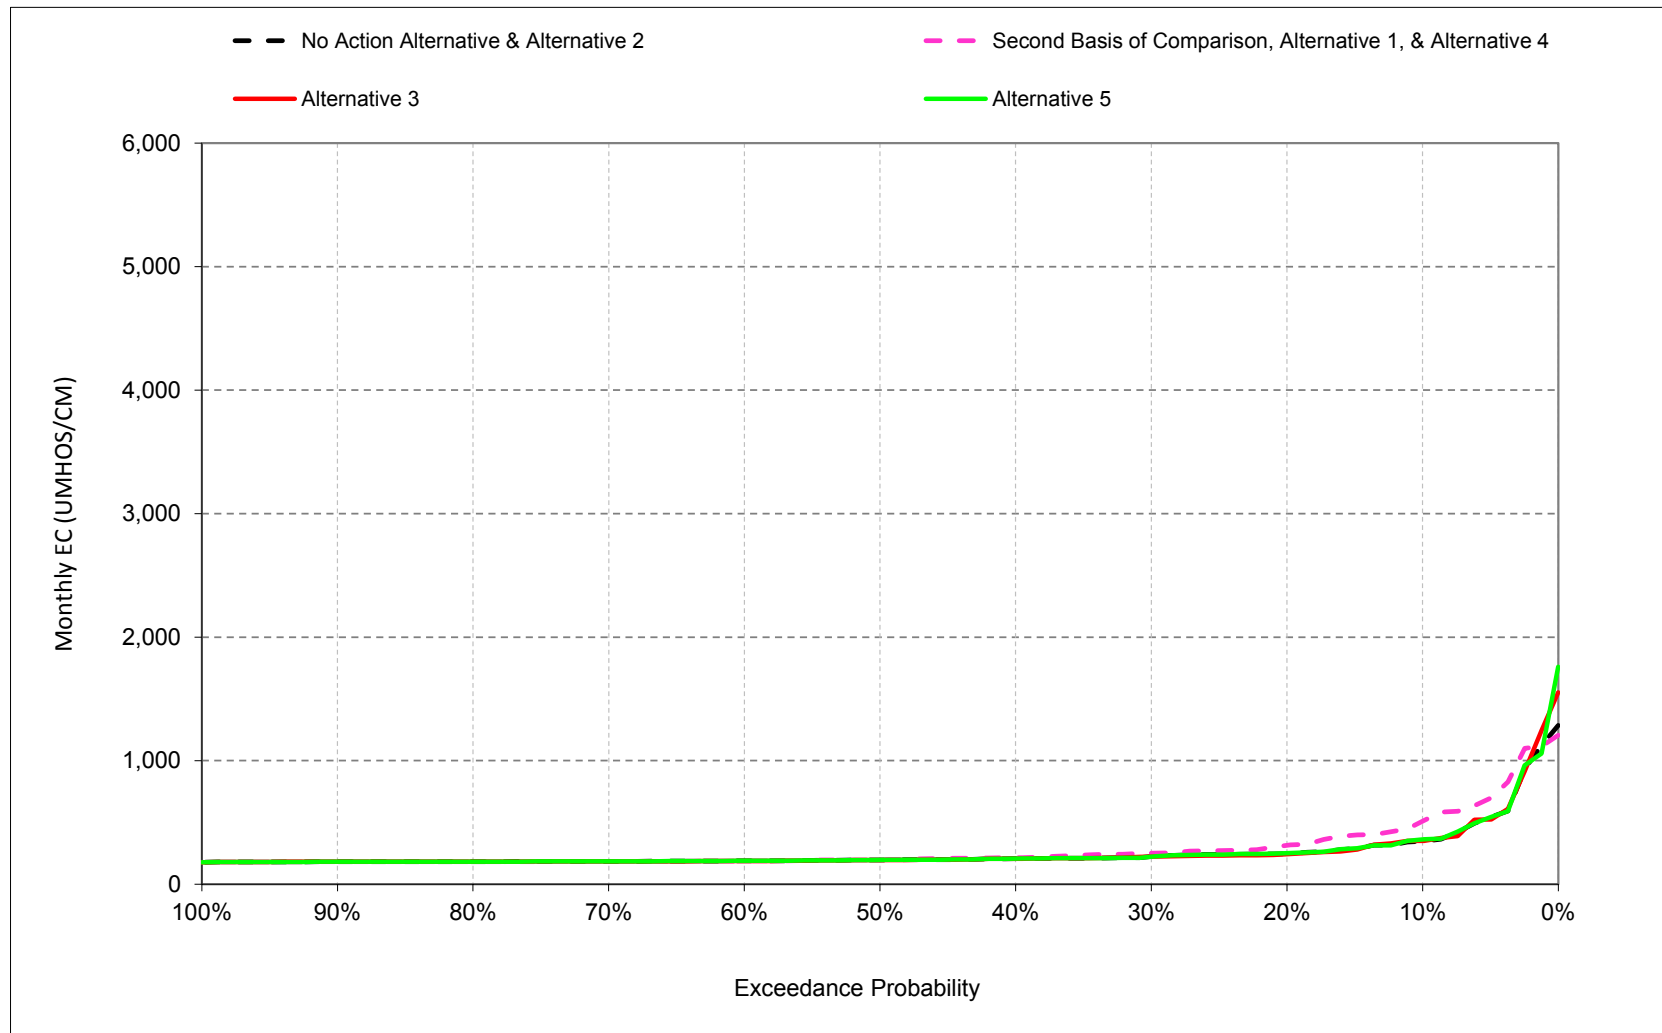


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.2.6. Sacramento River at Emmaton Salinity, Electrical Conductivity, March

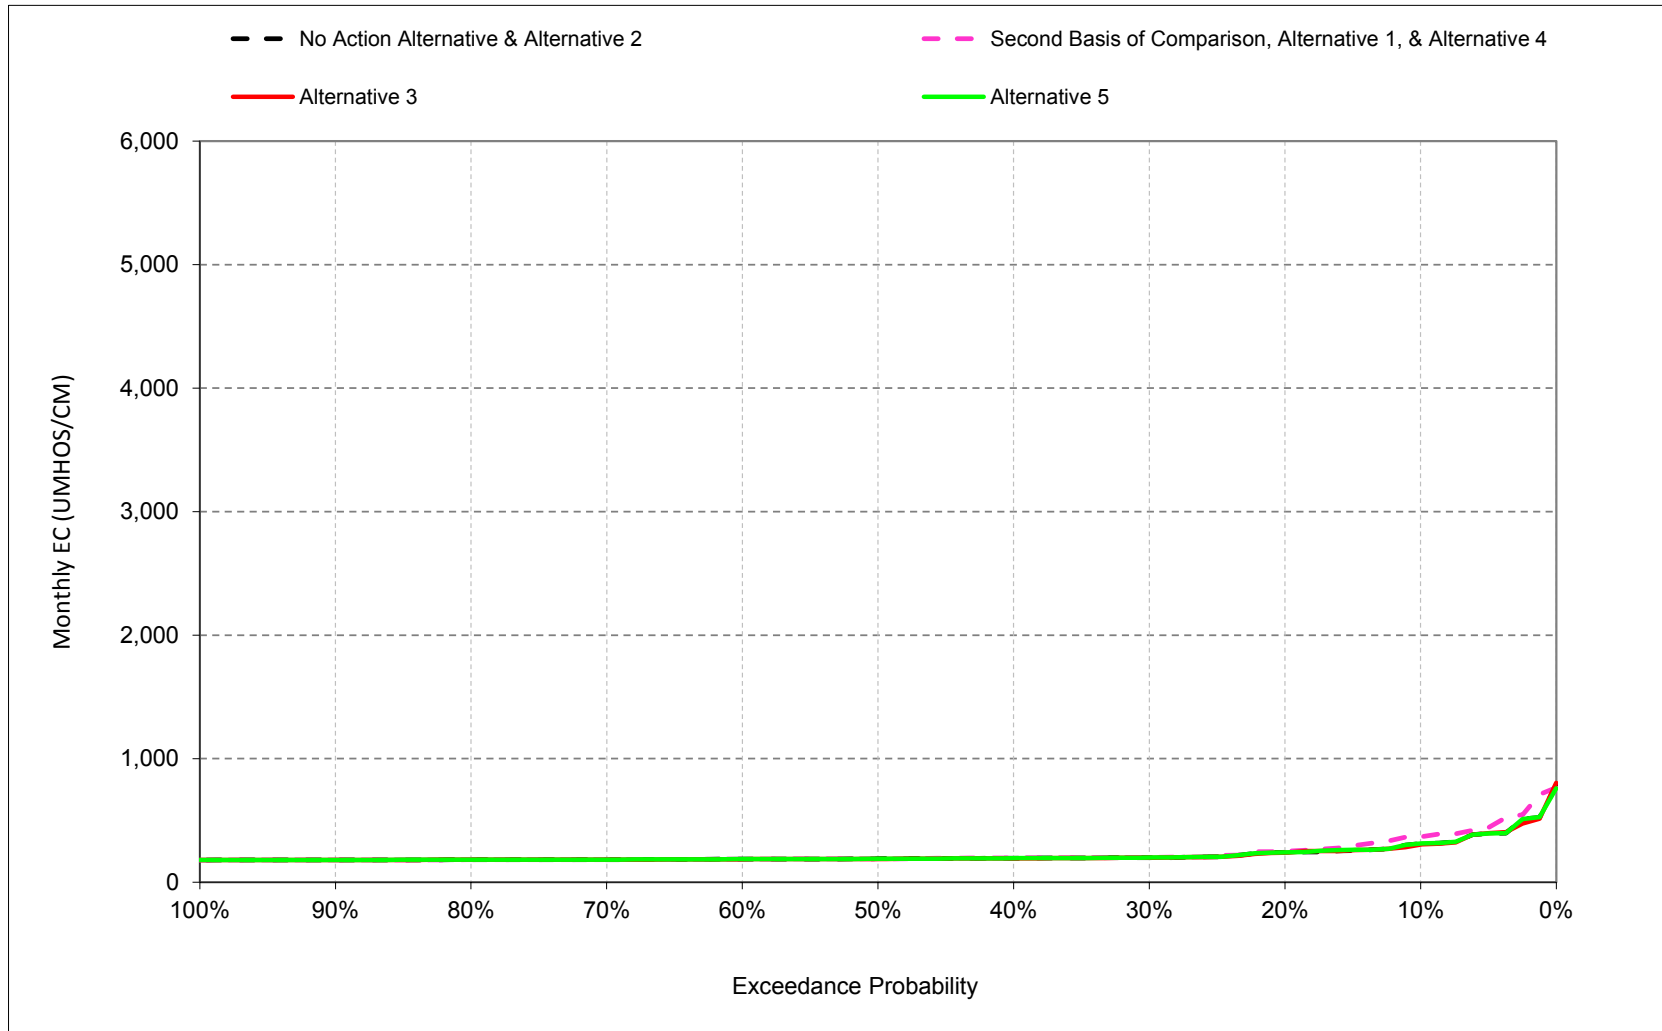


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.2.7. Sacramento River at Emmaton Salinity, Electrical Conductivity, April

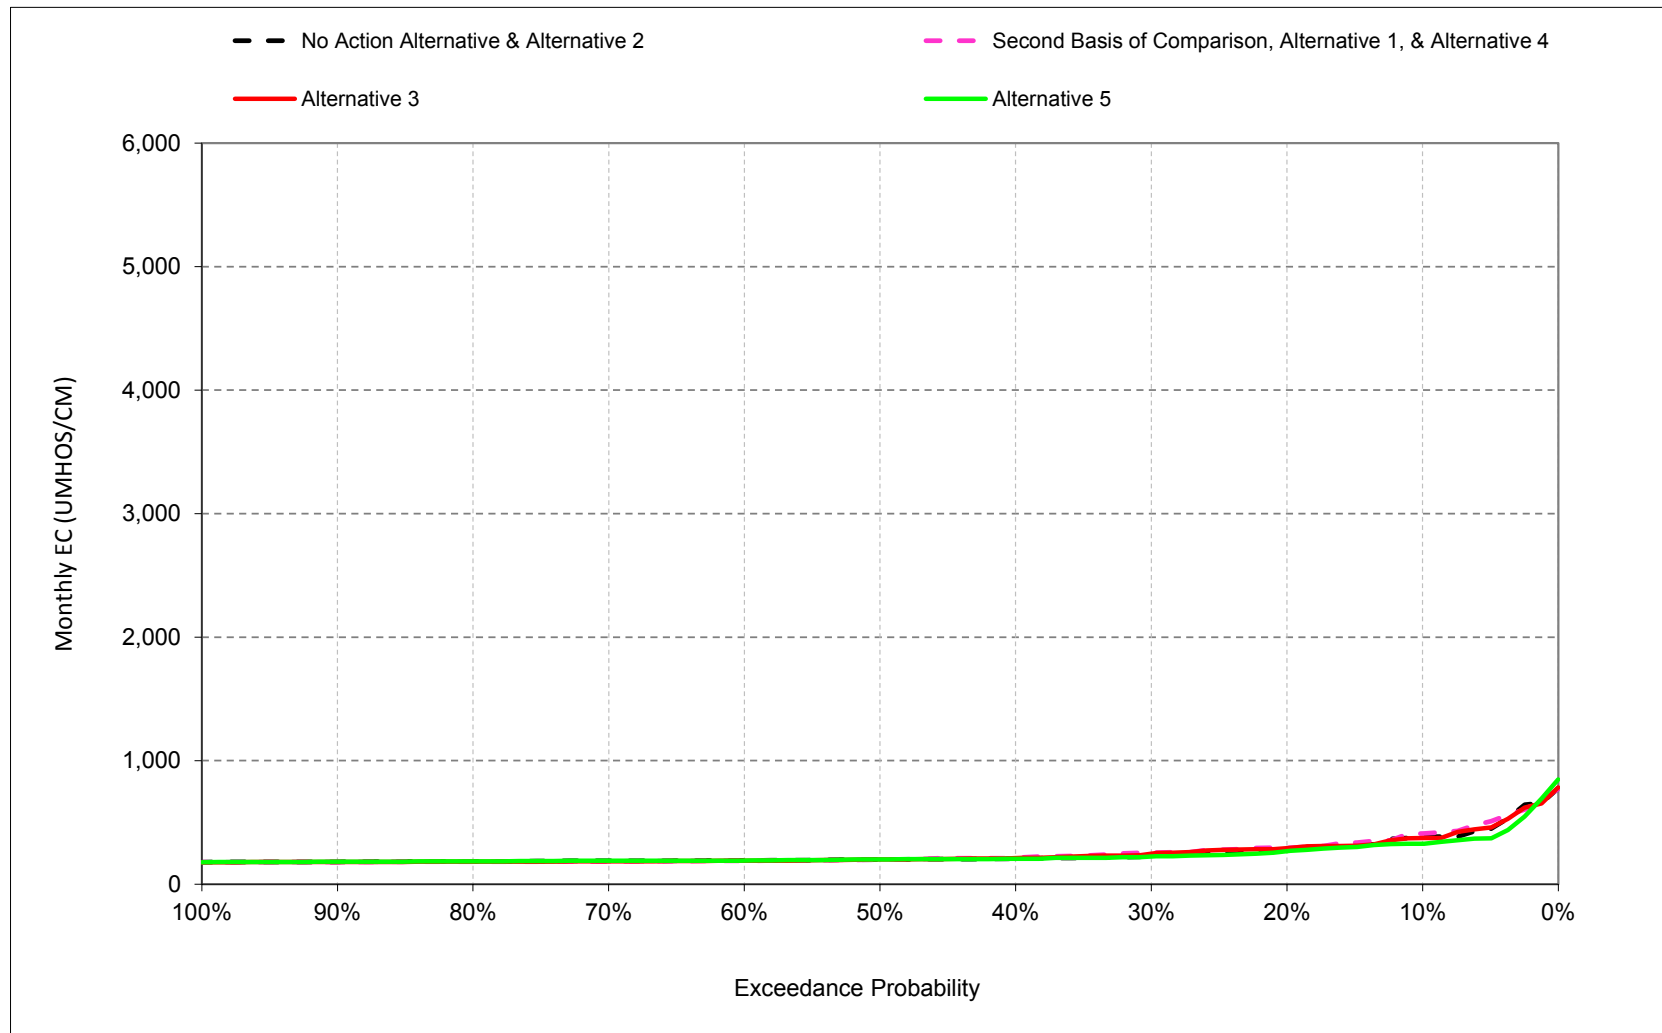


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.2.8. Sacramento River at Emmaton Salinity, Electrical Conductivity, May

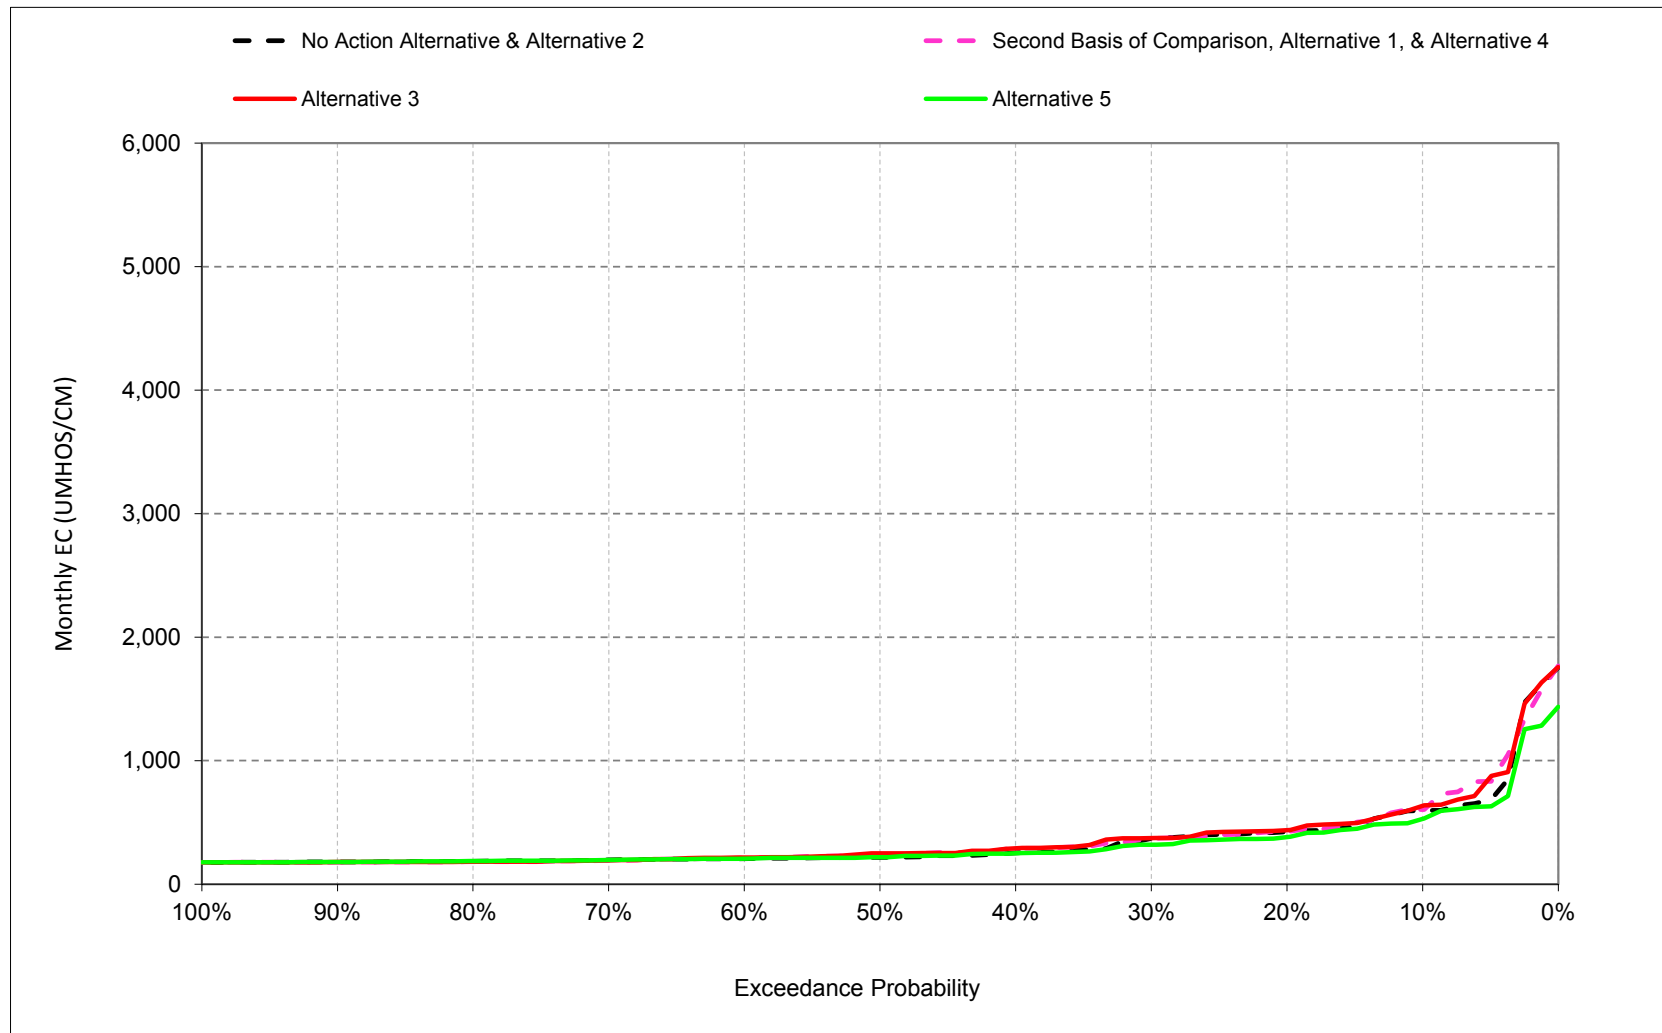


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.2.9. Sacramento River at Emmaton Salinity, Electrical Conductivity, June

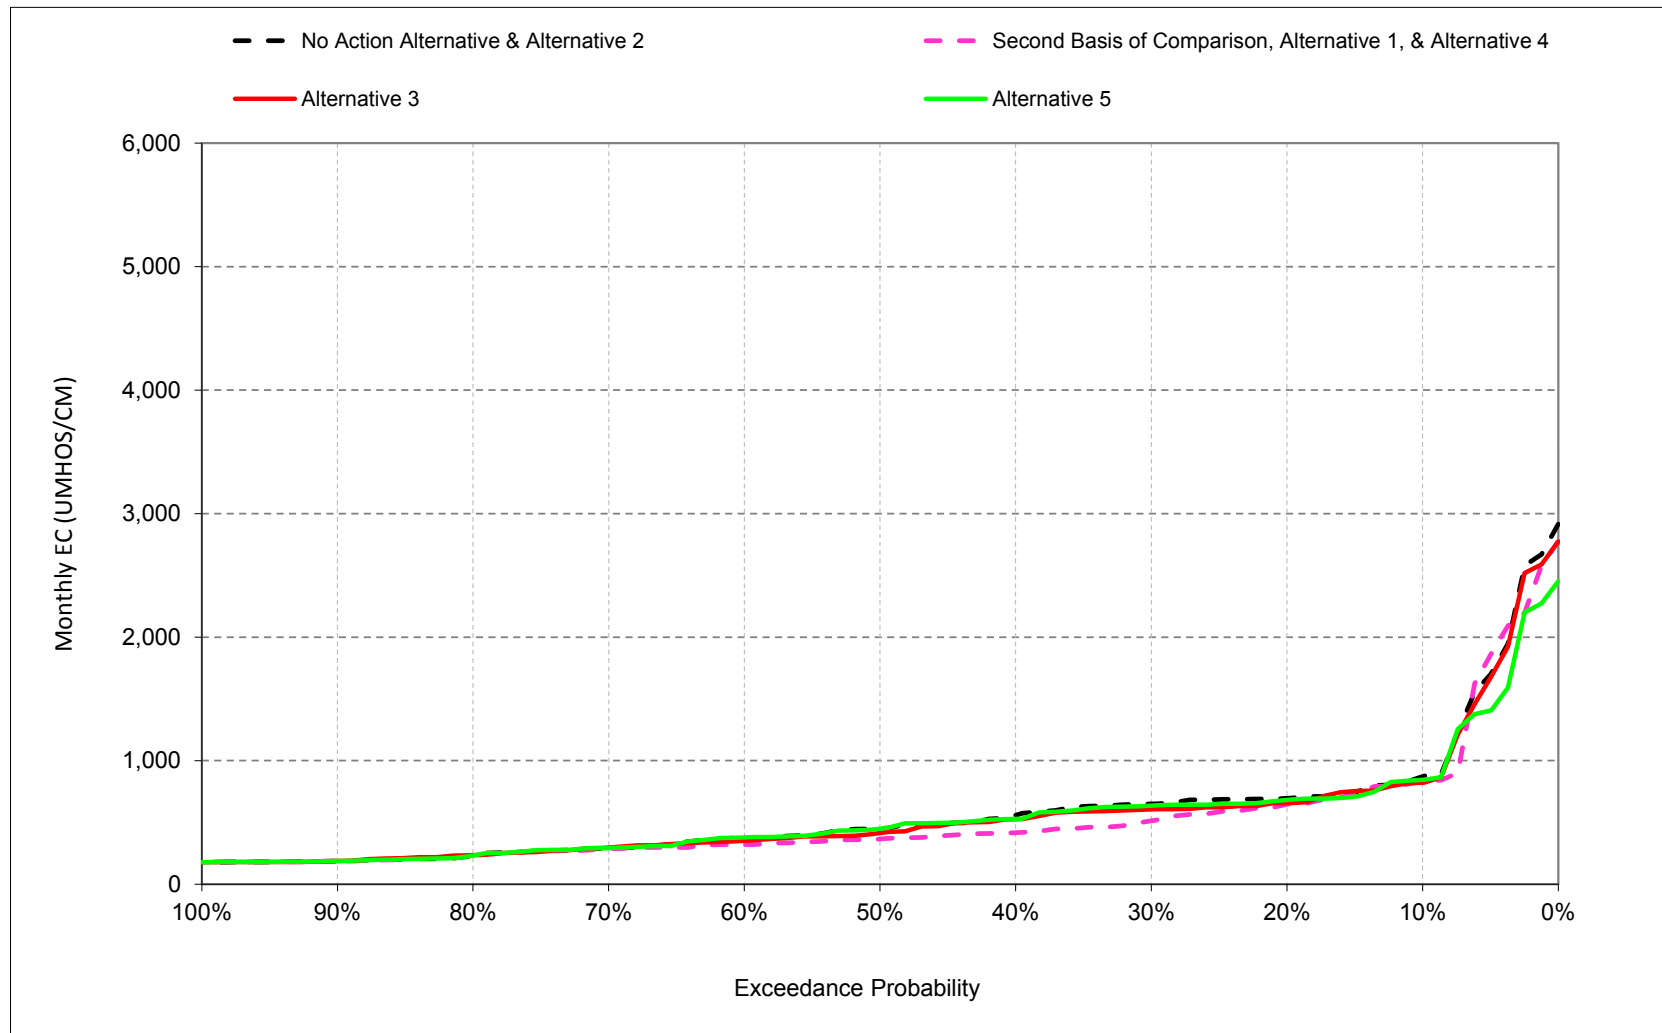


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.2.10. Sacramento River at Emmaton Salinity, Electrical Conductivity, July

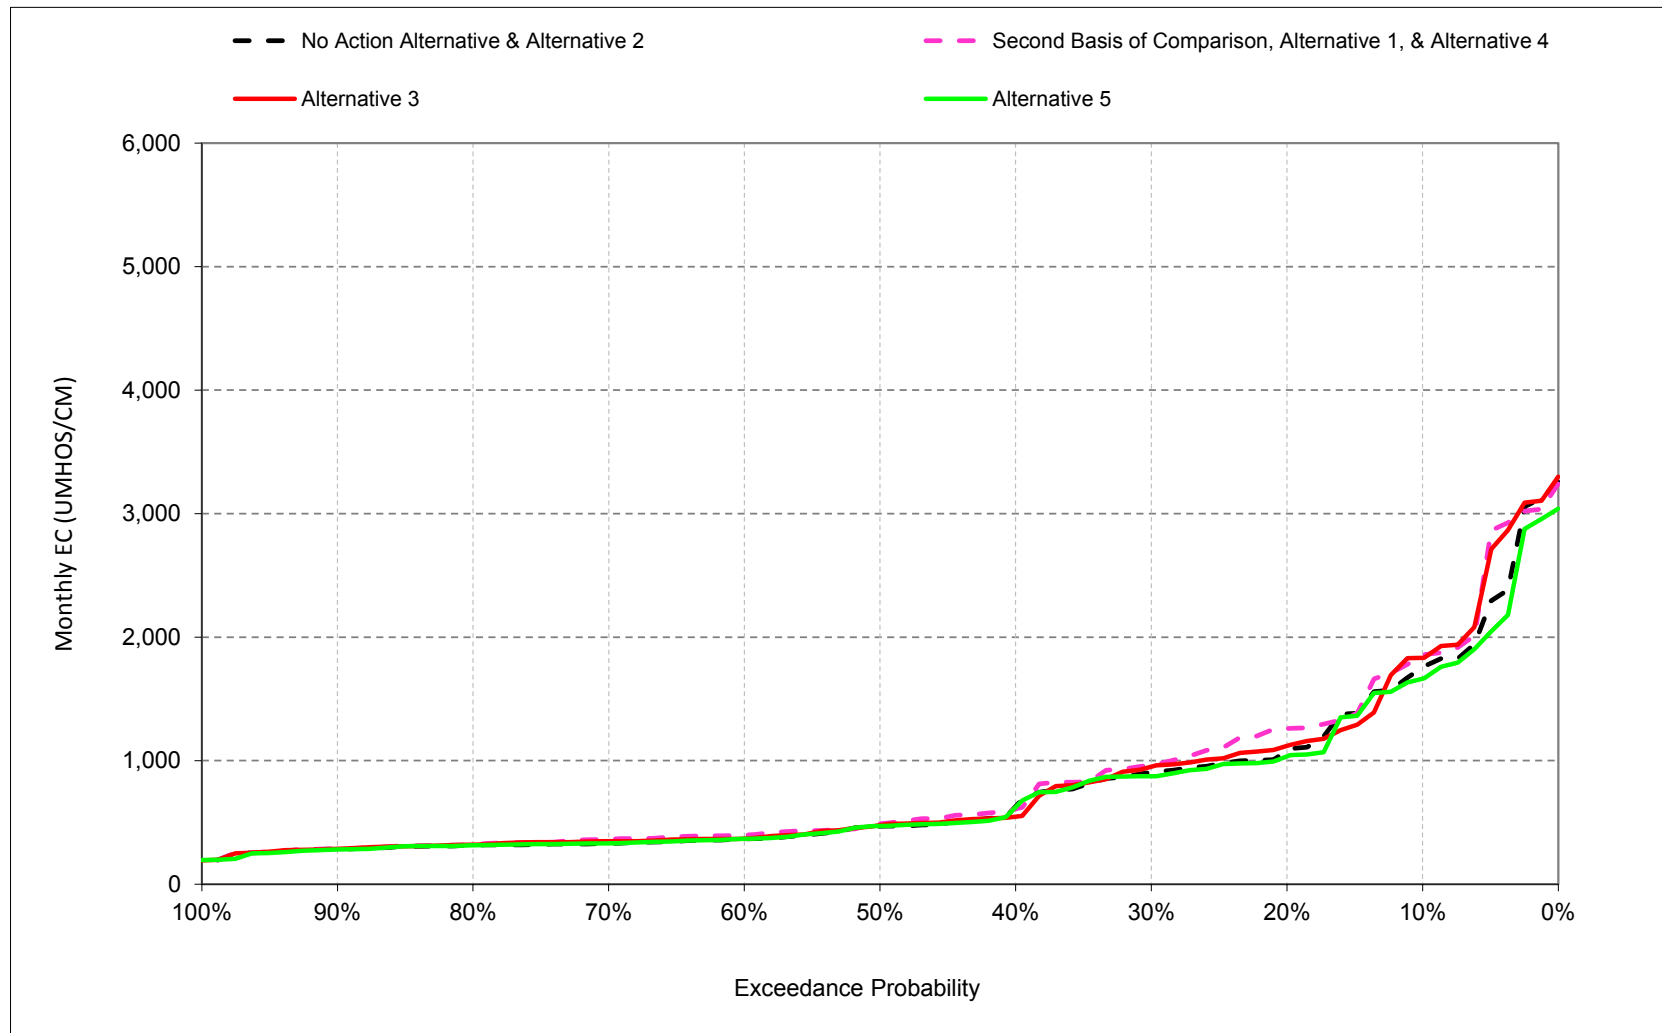


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.2.11. Sacramento River at Emmaton Salinity, Electrical Conductivity, August

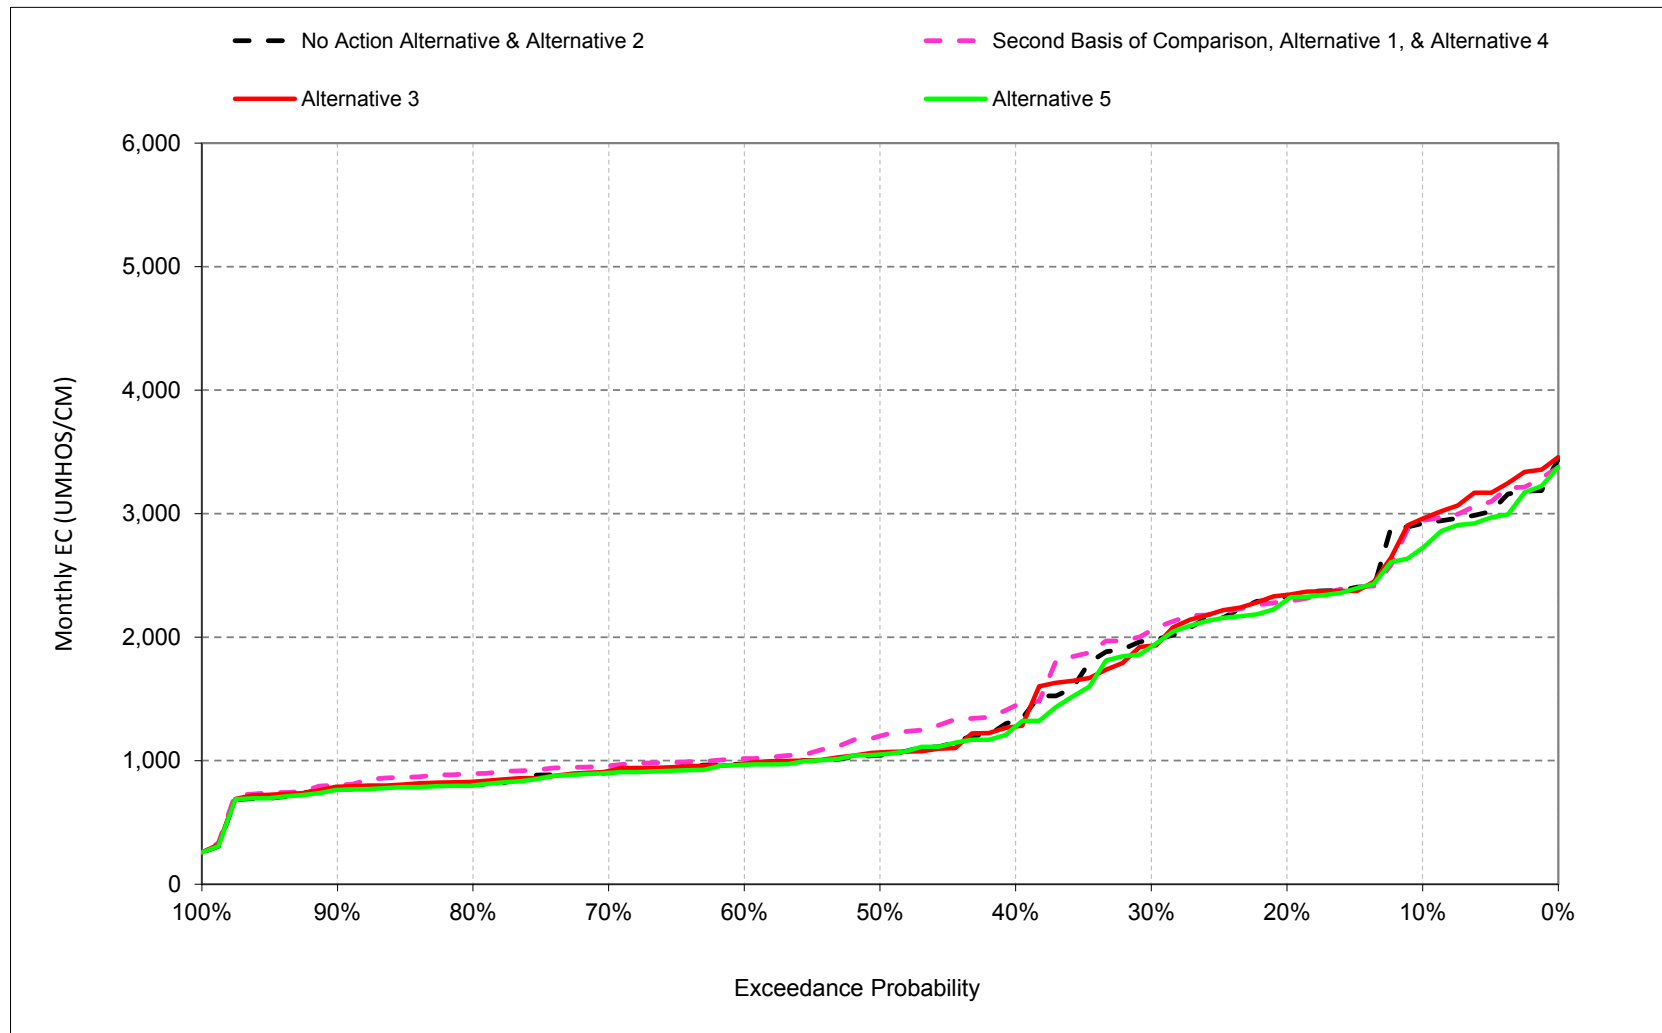

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.2.12. Sacramento River at Emmaton Salinity, Electrical Conductivity, September

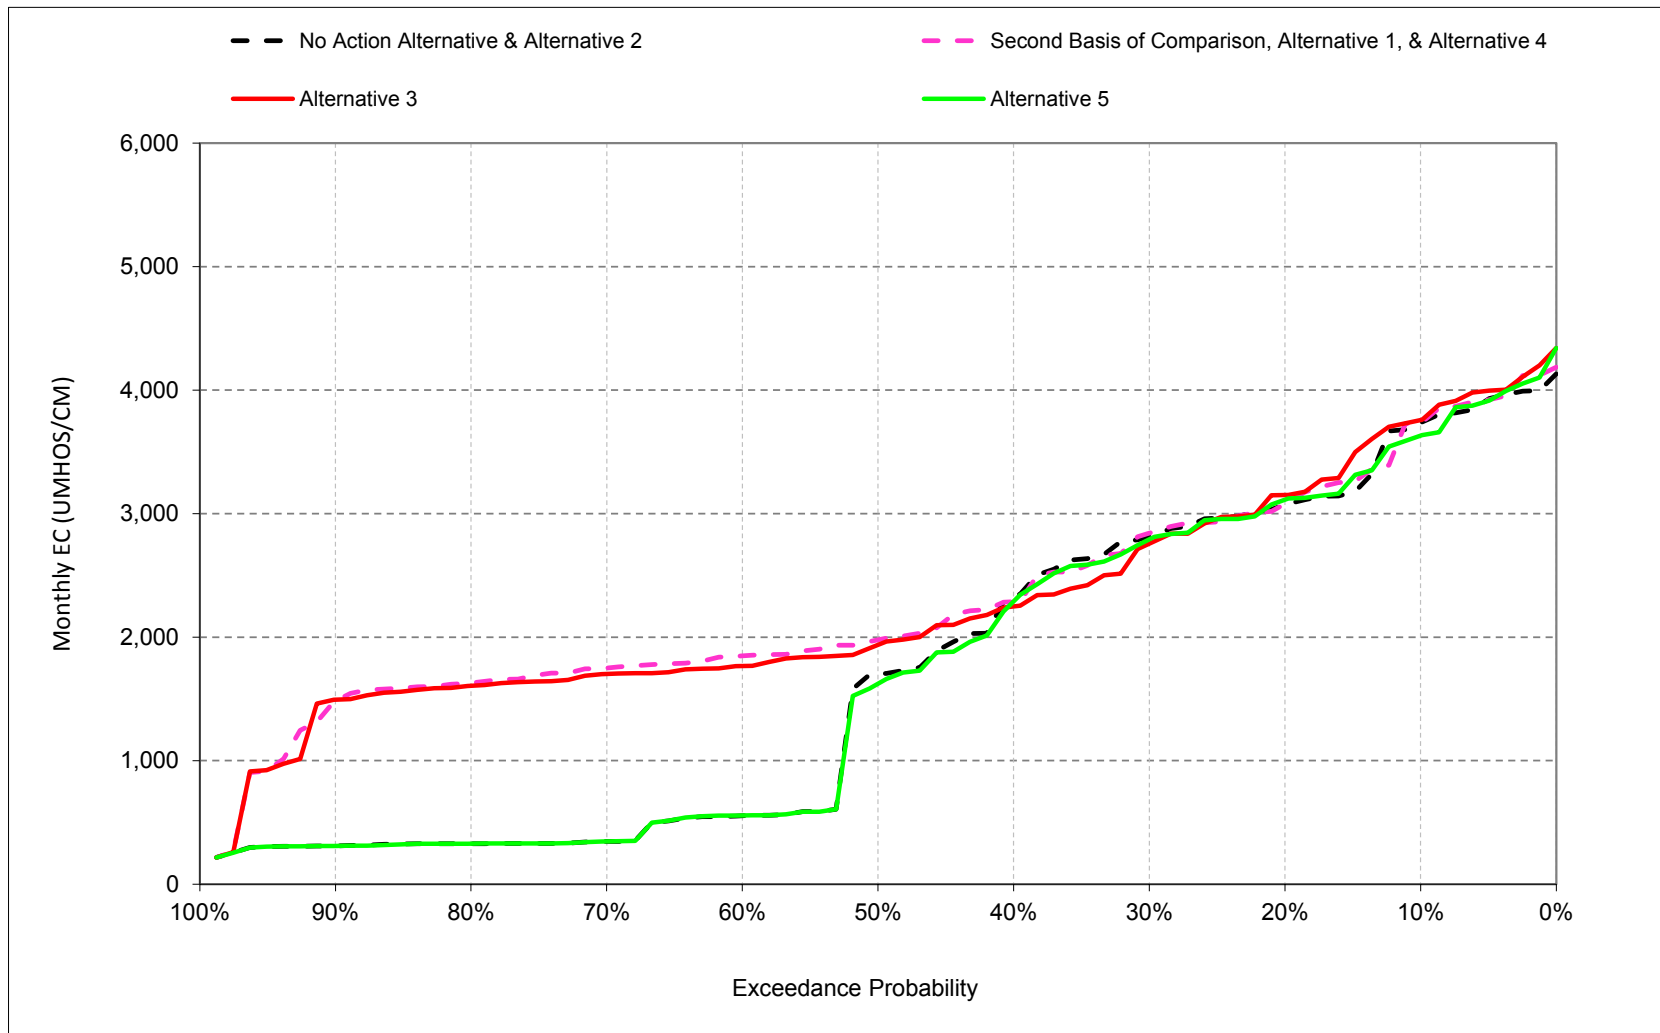

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.2.1. Sacramento River at Emmaton Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	4,353	4,269	2,750	963	348	313	382	596	871	1,756	2,920	3,735
20%	3,424	3,010	1,654	722	247	241	278	424	696	1,081	2,329	3,071
30%	3,256	2,642	883	543	224	199	232	370	650	906	1,977	2,813
40%	3,124	1,695	751	348	206	194	207	252	559	629	1,326	2,325
50%	2,357	562	564	307	196	190	200	217	451	469	1,044	1,702
60%	641	463	480	221	189	187	191	207	375	366	972	554
70%	308	258	247	195	184	183	189	197	292	330	903	347
80%	291	241	207	189	183	182	185	186	231	316	804	329
90%	270	229	182	182	182	181	181	180	188	285	768	313
Long Term												
Full Simulation Period ^b	2,011	1,571	982	473	259	224	246	342	587	779	1,491	1,709
Water Year Types ^c												
Wet (32%)	1,272	761	314	214	184	183	187	192	276	303	845	317
Above Normal (16%)	2,637	1,663	731	271	193	184	192	208	381	354	845	552
Below Normal (13%)	1,347	1,075	895	471	249	224	242	298	547	506	1,096	2,170
Dry (24%)	2,153	1,802	1,332	609	290	222	248	338	604	1,010	2,063	2,766
Critical (15%)	3,304	3,293	2,198	1,024	447	357	436	856	1,491	2,139	2,998	3,789
Alternative 1												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	4,287	3,938	2,758	1,462	511	368	410	605	835	1,851	2,940	3,740
20%	3,250	2,909	2,563	1,181	315	251	296	428	647	1,260	2,289	3,079
30%	3,121	2,689	2,067	852	251	201	255	367	513	966	2,055	2,842
40%	2,822	2,612	1,758	488	216	197	214	288	417	608	1,446	2,287
50%	2,597	2,289	1,235	371	199	189	200	233	367	490	1,199	1,978
60%	2,402	2,026	735	250	188	187	190	212	320	396	1,018	1,849
70%	2,147	1,849	388	201	185	183	185	191	288	365	959	1,749
80%	1,936	1,517	271	188	183	181	182	182	225	321	896	1,630
90%	1,544	474	192	182	182	180	180	179	188	289	803	1,482
Long Term												
Full Simulation Period ^b	2,653	2,272	1,393	621	288	236	255	355	531	834	1,549	2,292
Water Year Types ^c												
Wet (32%)	2,188	1,713	478	235	184	183	187	196	255	320	888	1,513
Above Normal (16%)	2,981	2,205	1,247	362	199	184	192	215	315	368	929	1,744
Below Normal (13%)	2,203	1,754	1,466	813	336	245	256	308	387	537	1,275	2,227
Dry (24%)	2,831	2,625	1,927	865	332	229	259	344	549	1,091	2,089	2,798
Critical (15%)	3,421	3,444	2,575	1,156	494	408	460	914	1,464	2,297	3,001	3,791
Alternative 1 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-66	-330	9	499	162	56	28	9	-37	95	20	5
20%	-174	-101	909	459	68	9	18	4	-49	180	-40	8
30%	-135	47	1,184	308	28	3	23	-3	-137	60	79	29
40%	-303	918	1,007	140	9	3	8	35	-142	-21	120	-37
50%	240	1,727	671	63	3	-1	0	16	-84	21	155	276
60%	1,761	1,562	255	29	-2	0	-1	5	-54	30	46	1,295
70%	1,839	1,591	141	6	0	0	-4	-5	-5	35	56	1,402
80%	1,646	1,276	64	-1	0	0	-2	-4	-6	5	92	1,301
90%	1,274	245	10	0	0	0	-1	-1	0	4	36	1,169
Long Term												
Full Simulation Period ^b	642	702	410	148	29	12	8	13	-56	55	58	584
Water Year Types ^c												
Wet (32%)	916	952	164	21	0	0	0	4	-22	18	43	1,195
Above Normal (16%)	344	542	515	91	6	0	0	7	-66	14	84	1,192
Below Normal (13%)	856	680	571	342	87	21	14	9	-159	31	179	57
Dry (24%)	678	823	594	256	41	7	12	6	-55	81	27	31
Critical (15%)	116	150	377	132	47	52	24	58	-26	158	3	3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.2.2. Sacramento River at Emmaton Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	4,353	4,269	2,750	963	348	313	382	596	871	1,756	2,920	3,735
20%	3,424	3,010	1,654	722	247	241	278	424	696	1,081	2,329	3,071
30%	3,256	2,642	883	543	224	199	232	370	650	906	1,977	2,813
40%	3,124	1,695	751	348	206	194	207	252	559	629	1,326	2,325
50%	2,357	562	564	307	196	190	200	217	451	469	1,044	1,702
60%	641	463	480	221	189	187	191	207	375	366	972	554
70%	308	258	247	195	184	183	189	197	292	330	903	347
80%	291	241	207	189	183	182	185	186	231	316	804	329
90%	270	229	182	182	182	181	181	180	188	285	768	313
Long Term												
Full Simulation Period ^b	2,011	1,571	982	473	259	224	246	342	587	779	1,491	1,709
Water Year Types ^c												
Wet (32%)	1,272	761	314	214	184	183	187	192	276	303	845	317
Above Normal (16%)	2,637	1,663	731	271	193	184	192	208	381	354	845	552
Below Normal (13%)	1,347	1,075	895	471	249	224	242	298	547	506	1,096	2,170
Dry (24%)	2,153	1,802	1,332	609	290	222	248	338	604	1,010	2,063	2,766
Critical (15%)	3,304	3,293	2,198	1,024	447	357	436	856	1,491	2,139	2,998	3,789
Alternative 3												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	4,351	4,124	2,740	1,155	351	305	373	633	821	1,832	2,958	3,758
20%	3,452	2,991	2,496	904	243	239	292	438	656	1,120	2,342	3,150
30%	3,196	2,776	2,053	739	222	198	246	374	605	951	1,930	2,757
40%	2,943	2,604	1,525	405	207	193	211	290	526	548	1,277	2,249
50%	2,584	2,400	1,232	314	195	189	199	249	413	478	1,067	1,938
60%	2,398	2,082	782	222	188	186	190	217	351	370	976	1,765
70%	2,227	1,772	349	196	184	183	186	193	297	348	918	1,702
80%	1,956	1,484	260	187	182	181	182	181	234	321	828	1,606
90%	1,531	575	191	182	182	181	180	179	187	287	790	1,499
Long Term												
Full Simulation Period ^b	2,729	2,324	1,361	557	262	223	249	358	565	806	1,504	2,271
Water Year Types ^c												
Wet (32%)	2,196	1,742	472	225	184	183	186	200	273	312	854	1,516
Above Normal (16%)	3,143	2,217	1,153	305	191	183	192	217	353	359	879	1,730
Below Normal (13%)	2,323	1,808	1,467	634	254	225	248	324	523	504	1,064	1,989
Dry (24%)	2,860	2,688	1,906	737	286	221	252	350	578	1,016	2,073	2,822
Critical (15%)	3,587	3,566	2,509	1,181	477	354	444	895	1,444	2,286	3,046	3,837
Alternative 3 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-2	-145	-10	192	2	-8	-9	37	-50	76	38	23
20%	28	-18	841	182	-5	-2	14	14	-40	40	13	79
30%	-60	134	1,170	196	-1	0	14	4	-45	45	-47	-56
40%	-181	909	774	57	1	-1	5	37	-33	-81	-49	-76
50%	227	1,838	668	7	-1	-1	0	32	-38	9	23	235
60%	1,757	1,618	302	1	-1	-1	-1	10	-24	3	4	1,211
70%	1,919	1,513	103	0	0	0	-3	-4	5	17	15	1,355
80%	1,666	1,243	53	-2	0	0	-3	-4	3	5	24	1,278
90%	1,261	346	9	0	0	0	-1	-1	-1	2	22	1,186
Long Term												
Full Simulation Period ^b	718	753	379	85	3	-1	3	16	-22	26	13	563
Water Year Types ^c												
Wet (32%)	923	981	157	11	0	0	0	8	-4	9	9	1,198
Above Normal (16%)	506	554	422	35	-2	-1	-1	9	-28	5	34	1,177
Below Normal (13%)	976	734	571	162	5	1	6	25	-24	-2	-32	-181
Dry (24%)	707	887	574	128	-4	-2	4	12	-25	6	10	55
Critical (15%)	283	273	311	156	29	-3	7	39	-47	147	48	48

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.2.3. Sacramento River at Emmaton Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	4,353	4,269	2,750	963	348	313	382	596	871	1,756	2,920	3,735
20%	3,424	3,010	1,654	722	247	241	278	424	696	1,081	2,329	3,071
30%	3,256	2,642	883	543	224	199	232	370	650	906	1,977	2,813
40%	3,124	1,695	751	348	206	194	207	252	559	629	1,326	2,325
50%	2,357	562	564	307	196	190	200	217	451	469	1,044	1,702
60%	641	463	480	221	189	187	191	207	375	366	972	554
70%	308	258	247	195	184	183	189	197	292	330	903	347
80%	291	241	207	189	183	182	185	186	231	316	804	329
90%	270	229	182	182	182	181	181	180	188	285	768	313
Long Term												
Full Simulation Period ^b	2,011	1,571	982	473	259	224	246	342	587	779	1,491	1,709
Water Year Types ^c												
Wet (32%)	1,272	761	314	214	184	183	187	192	276	303	845	317
Above Normal (16%)	2,637	1,663	731	271	193	184	192	208	381	354	845	552
Below Normal (13%)	1,347	1,075	895	471	249	224	242	298	547	506	1,096	2,170
Dry (24%)	2,153	1,802	1,332	609	290	222	248	338	604	1,010	2,063	2,766
Critical (15%)	3,304	3,293	2,198	1,024	447	357	436	856	1,491	2,139	2,998	3,789

Alternative 5												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	4,359	4,137	2,757	961	362	313	326	528	845	1,664	2,721	3,631
20%	3,466	3,015	1,604	723	251	242	267	382	683	1,034	2,303	3,113
30%	3,215	2,659	892	544	223	199	224	319	637	874	1,921	2,792
40%	3,112	1,684	754	348	206	194	206	250	528	623	1,276	2,289
50%	2,357	552	563	307	196	190	200	218	449	470	1,050	1,622
60%	641	463	480	220	189	187	192	207	378	367	966	557
70%	309	258	247	195	185	183	189	197	292	332	901	349
80%	292	240	207	188	183	182	185	187	231	315	800	329
90%	270	228	182	182	182	181	181	180	188	281	762	312
Long Term												
Full Simulation Period ^b	2,004	1,565	987	483	264	224	239	318	555	757	1,457	1,699
Water Year Types ^c												
Wet (32%)	1,271	766	315	214	184	183	187	192	278	300	832	317
Above Normal (16%)	2,611	1,640	723	271	193	184	192	210	382	354	847	555
Below Normal (13%)	1,350	1,079	897	472	249	224	235	286	546	504	1,079	2,118
Dry (24%)	2,153	1,797	1,343	616	292	222	236	324	585	983	2,017	2,758
Critical (15%)	3,288	3,275	2,218	1,082	484	357	412	729	1,305	2,037	2,882	3,781

Alternative 5 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	6	-132	7	-2	14	1	-56	-68	-26	-92	-199	-105
20%	42	6	-51	1	4	0	-11	-43	-13	-46	-27	42
30%	-41	17	10	1	-1	0	-8	-50	-13	-32	-55	-21
40%	-13	-11	2	0	0	0	-1	-2	-30	-6	-50	-36
50%	0	-10	-1	0	0	0	0	1	-2	2	7	-80
60%	0	-1	0	0	0	0	0	0	3	1	-6	3
70%	1	0	0	0	0	0	0	0	0	2	-2	2
80%	1	-1	1	-1	0	0	0	1	0	0	-4	0
90%	0	-1	0	0	0	0	0	0	0	-3	-6	-1
Long Term												
Full Simulation Period ^b	-7	-5	4	10	6	0	-7	-24	-31	-23	-34	-10
Water Year Types ^c												
Wet (32%)	-1	4	0	0	0	0	0	-1	1	-3	-13	0
Above Normal (16%)	-26	-23	-8	0	0	0	0	1	1	0	2	2
Below Normal (13%)	3	5	1	1	0	0	-7	-12	-1	-2	-17	-53
Dry (24%)	0	-4	10	7	2	0	-12	-14	-19	-27	-46	-9
Critical (15%)	-17	-18	20	58	37	1	-25	-127	-186	-102	-116	-7

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.2.4. Sacramento River at Emmaton Salinity, Monthly EC

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance^a												
10%	4,287	3,938	2,758	1,462	511	368	410	605	835	1,851	2,940	3,740
20%	3,250	2,909	2,563	1,181	315	251	296	428	647	1,260	2,289	3,079
30%	3,121	2,689	2,067	852	251	201	255	367	513	966	2,055	2,842
40%	2,822	2,612	1,758	488	216	197	214	288	417	608	1,446	2,287
50%	2,597	2,289	1,235	371	199	189	200	233	367	490	1,199	1,978
60%	2,402	2,026	735	250	188	187	190	212	320	396	1,018	1,849
70%	2,147	1,849	388	201	185	183	185	191	288	365	959	1,749
80%	1,936	1,517	271	188	183	181	182	182	225	321	896	1,630
90%	1,544	474	192	182	182	180	180	179	188	289	803	1,482
Long Term												
Full Simulation Period ^b	2,653	2,272	1,393	621	288	236	255	355	531	834	1,549	2,292
Water Year Types^c												
Wet (32%)	2,188	1,713	478	235	184	183	187	196	255	320	888	1,513
Above Normal (16%)	2,981	2,205	1,247	362	199	184	192	215	315	368	929	1,744
Below Normal (13%)	2,203	1,754	1,466	813	336	245	256	308	387	537	1,275	2,227
Dry (24%)	2,831	2,625	1,927	865	332	229	259	344	549	1,091	2,089	2,798
Critical (15%)	3,421	3,444	2,575	1,156	494	408	460	914	1,464	2,297	3,001	3,791

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance^a												
10%	4,353	4,269	2,750	963	348	313	382	596	871	1,756	2,920	3,735
20%	3,424	3,010	1,654	722	247	241	278	424	696	1,081	2,329	3,071
30%	3,256	2,642	883	543	224	199	232	370	650	906	1,977	2,813
40%	3,124	1,695	751	348	206	194	207	252	559	629	1,326	2,325
50%	2,357	562	564	307	196	190	200	217	451	469	1,044	1,702
60%	641	463	480	221	189	187	191	207	375	366	972	554
70%	308	258	247	195	184	183	189	197	292	330	903	347
80%	291	241	207	189	183	182	185	186	231	316	804	329
90%	270	229	182	182	182	181	181	180	188	285	768	313
Long Term												
Full Simulation Period ^b	2,011	1,571	982	473	259	224	246	342	587	779	1,491	1,709
Water Year Types^c												
Wet (32%)	1,272	761	314	214	184	183	187	192	276	303	845	317
Above Normal (16%)	2,637	1,663	731	271	193	184	192	208	381	354	845	552
Below Normal (13%)	1,347	1,075	895	471	249	224	242	298	547	506	1,096	2,170
Dry (24%)	2,153	1,802	1,332	609	290	222	248	338	604	1,010	2,063	2,766
Critical (15%)	3,304	3,293	2,198	1,024	447	357	436	856	1,491	2,139	2,998	3,789

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative minus Second Basis of Comparison												
Probability of Exceedance^a												
10%	66	330	-9	-499	-162	-56	-28	-9	37	-95	-20	-5
20%	174	101	-909	-459	-68	-9	-18	-4	49	-180	40	-8
30%	135	-47	-1,184	-308	-28	-3	-23	3	137	-60	-79	-29
40%	303	-918	-1,007	-140	-9	-3	-8	-35	142	21	-120	37
50%	-240	-1,727	-671	-63	-3	1	0	-16	84	-21	-155	-276
60%	-1,761	-1,562	-255	-29	2	0	1	-5	54	-30	-46	-1,295
70%	-1,839	-1,591	-141	-6	0	0	4	5	5	-35	-56	-1,402
80%	-1,646	-1,276	-64	1	0	0	2	4	6	-5	-92	-1,301
90%	-1,274	-245	-10	0	0	0	1	1	0	-4	-36	-1,169
Long Term												
Full Simulation Period ^b	-642	-702	-410	-148	-29	-12	-8	-13	56	-55	-58	-584
Water Year Types^c												
Wet (32%)	-916	-952	-164	-21	0	0	0	-4	22	-18	-43	-1,195
Above Normal (16%)	-344	-542	-515	-91	-6	0	0	-7	66	-14	-84	-1,192
Below Normal (13%)	-856	-680	-571	-342	-87	-21	-14	-9	159	-31	-179	-57
Dry (24%)	-678	-823	-594	-256	-41	-7	-12	-6	55	-81	-27	-31
Critical (15%)	-116	-150	-377	-132	-47	-52	-24	-58	26	-158	-3	-3

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.2.5. Sacramento River at Emmaton Salinity, Monthly EC

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	4,287	3,938	2,758	1,462	511	368	410	605	835	1,851	2,940	3,740
20%	3,250	2,909	2,563	1,181	315	251	296	428	647	1,260	2,289	3,079
30%	3,121	2,689	2,067	852	251	201	255	367	513	966	2,055	2,842
40%	2,822	2,612	1,758	488	216	197	214	288	417	608	1,446	2,287
50%	2,597	2,289	1,235	371	199	189	200	233	367	490	1,199	1,978
60%	2,402	2,026	735	250	188	187	190	212	320	396	1,018	1,849
70%	2,147	1,849	388	201	185	183	185	191	288	365	959	1,749
80%	1,936	1,517	271	188	183	181	182	182	225	321	896	1,630
90%	1,544	474	192	182	182	180	180	179	188	289	803	1,482
Long Term												
Full Simulation Period ^b	2,653	2,272	1,393	621	288	236	255	355	531	834	1,549	2,292
Water Year Types ^c												
Wet (32%)	2,188	1,713	478	235	184	183	187	196	255	320	888	1,513
Above Normal (16%)	2,981	2,205	1,247	362	199	184	192	215	315	368	929	1,744
Below Normal (13%)	2,203	1,754	1,466	813	336	245	256	308	387	537	1,275	2,227
Dry (24%)	2,831	2,625	1,927	865	332	229	259	344	549	1,091	2,089	2,798
Critical (15%)	3,421	3,444	2,575	1,156	494	408	460	914	1,464	2,297	3,001	3,791

Alternative 3

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	4,351	4,124	2,740	1,155	351	305	373	633	821	1,832	2,958	3,758
20%	3,452	2,991	2,496	904	243	239	292	438	656	1,120	2,342	3,150
30%	3,196	2,776	2,053	739	222	198	246	374	605	951	1,930	2,757
40%	2,943	2,604	1,525	405	207	193	211	290	526	548	1,277	2,249
50%	2,584	2,400	1,232	314	195	189	199	249	413	478	1,067	1,938
60%	2,398	2,082	782	222	188	186	190	217	351	370	976	1,765
70%	2,227	1,772	349	196	184	183	186	193	297	348	918	1,702
80%	1,956	1,484	260	187	182	181	182	181	234	321	828	1,606
90%	1,531	575	191	182	182	181	180	179	187	287	790	1,499
Long Term												
Full Simulation Period ^b	2,729	2,324	1,361	557	262	223	249	358	565	806	1,504	2,271
Water Year Types ^c												
Wet (32%)	2,196	1,742	472	225	184	183	186	200	273	312	854	1,516
Above Normal (16%)	3,143	2,217	1,153	305	191	183	192	217	353	359	879	1,730
Below Normal (13%)	2,323	1,808	1,467	634	254	225	248	324	523	504	1,064	1,989
Dry (24%)	2,860	2,688	1,906	737	286	221	252	350	578	1,016	2,073	2,822
Critical (15%)	3,587	3,566	2,509	1,181	477	354	444	895	1,444	2,286	3,046	3,837

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	64	185	-19	-307	-160	-63	-36	28	-13	-19	18	18
20%	202	82	-67	-276	-72	-12	-4	10	9	-140	53	71
30%	75	86	-14	-112	-29	-3	-8	7	92	-16	-125	-85
40%	122	-9	-234	-83	-9	-4	-3	2	109	-61	-169	-39
50%	-13	111	-3	-56	-4	-1	0	16	47	-11	-132	-41
60%	-4	56	47	-28	0	0	0	5	30	-27	-42	-84
70%	80	-77	-38	-6	0	0	0	2	9	-17	-41	-47
80%	20	-33	-11	0	0	0	0	0	9	0	-68	-23
90%	-13	100	-1	0	0	0	0	0	-1	-2	-13	17
Long Term												
Full Simulation Period ^b	75	52	-31	-64	-26	-13	-6	3	34	-28	-44	-21
Water Year Types ^c												
Wet (32%)	7	29	-7	-10	0	0	0	4	18	-9	-34	3
Above Normal (16%)	162	12	-93	-56	-8	0	0	2	37	-9	-50	-14
Below Normal (13%)	120	54	1	-179	-82	-20	-8	16	135	-33	-211	-238
Dry (24%)	29	64	-20	-128	-46	-9	-7	6	29	-75	-16	24
Critical (15%)	166	122	-66	25	-17	-54	-17	-18	-20	-11	44	45

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.2.6. Sacramento River at Emmaton Salinity, Monthly EC

Statistic		Monthly EC (UMHOS/CM)											
		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		4,287	3,938	2,758	1,462	511	368	410	605	835	1,851	2,940	3,740
20%		3,250	2,909	2,563	1,181	315	251	296	428	647	1,260	2,289	3,079
30%		3,121	2,689	2,067	852	251	201	255	367	513	966	2,055	2,842
40%		2,822	2,612	1,758	488	216	197	214	288	417	608	1,446	2,287
50%		2,597	2,289	1,235	371	199	189	200	233	367	490	1,199	1,978
60%		2,402	2,026	735	250	188	187	190	212	320	396	1,018	1,849
70%		2,147	1,849	388	201	185	183	185	191	288	365	959	1,749
80%		1,936	1,517	271	188	183	181	182	182	225	321	896	1,630
90%		1,544	474	192	182	182	180	180	179	188	289	803	1,482
Long Term													
Full Simulation Period ^b		2,653	2,272	1,393	621	288	236	255	355	531	834	1,549	2,292
Water Year Types ^c													
Wet (32%)		2,188	1,713	478	235	184	183	187	196	255	320	888	1,513
Above Normal (16%)		2,981	2,205	1,247	362	199	184	192	215	315	368	929	1,744
Below Normal (13%)		2,203	1,754	1,466	813	336	245	256	308	387	537	1,275	2,227
Dry (24%)		2,831	2,625	1,927	865	332	229	259	344	549	1,091	2,089	2,798
Critical (15%)		3,421	3,444	2,575	1,156	494	408	460	914	1,464	2,297	3,001	3,791

Alternative 5

Statistic		Monthly EC (UMHOS/CM)											
		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		4,359	4,137	2,757	961	362	313	326	528	845	1,664	2,721	3,631
20%		3,466	3,015	1,604	723	251	242	267	382	683	1,034	2,303	3,113
30%		3,215	2,659	892	544	223	199	224	319	637	874	1,921	2,792
40%		3,112	1,684	754	348	206	194	206	250	528	623	1,276	2,289
50%		2,357	552	563	307	196	190	200	218	449	470	1,050	1,622
60%		641	463	480	220	189	187	192	207	378	367	966	557
70%		309	258	247	195	185	183	189	197	292	332	901	349
80%		292	240	207	188	183	182	185	187	231	315	800	329
90%		270	228	182	182	182	181	181	180	188	281	762	312
Long Term													
Full Simulation Period ^b		2,004	1,565	987	483	264	224	239	318	555	757	1,457	1,699
Water Year Types ^c													
Wet (32%)		1,271	766	315	214	184	183	187	192	278	300	832	317
Above Normal (16%)		2,611	1,640	723	271	193	184	192	210	382	354	847	555
Below Normal (13%)		1,350	1,079	897	472	249	224	235	286	546	504	1,079	2,118
Dry (24%)		2,153	1,797	1,343	616	292	222	236	324	585	983	2,017	2,758
Critical (15%)		3,288	3,275	2,218	1,082	484	357	412	729	1,305	2,037	2,882	3,781

Alternative 5 minus Second Basis of Comparison

Statistic		Monthly EC (UMHOS/CM)											
		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		72	198	-1	-501	-149	-55	-84	-76	11	-187	-219	-110
20%		216	106	-959	-457	-64	-9	-29	-46	36	-226	14	34
30%		94	-30	-1,175	-308	-28	-2	-31	-48	124	-92	-134	-50
40%		290	-929	-1,005	-140	-9	-3	-8	-37	112	15	-170	1
50%		-240	-1,738	-671	-63	-3	1	0	-14	83	-19	-148	-356
60%		-1,761	-1,563	-255	-30	2	0	2	-4	58	-29	-51	-1,292
70%		-1,838	-1,591	-141	-6	0	0	4	6	5	-33	-58	-1,400
80%		-1,644	-1,277	-64	0	0	0	3	5	6	-5	-96	-1,301
90%		-1,274	-247	-10	0	0	0	1	1	0	-8	-41	-1,170
Long Term													
Full Simulation Period ^b		-649	-707	-406	-138	-24	-12	-15	-37	24	-77	-92	-593
Water Year Types ^c													
Wet (32%)		-917	-948	-163	-21	0	0	0	-5	23	-20	-56	-1,196
Above Normal (16%)		-370	-565	-523	-91	-6	0	1	-5	67	-14	-82	-1,189
Below Normal (13%)		-853	-675	-569	-341	-87	-21	-21	-22	158	-33	-196	-110
Dry (24%)		-678	-827	-584	-249	-39	-7	-23	-20	36	-108	-73	-40
Critical (15%)		-133	-168	-357	-74	-10	-51	-49	-185	-159	-260	-120	-10

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 **B.3. San Joaquin River at Jersey Point Salinity**

Figure 6E.B.3.1. San Joaquin River at Jersey Point Salinity, Electrical Conductivity, October

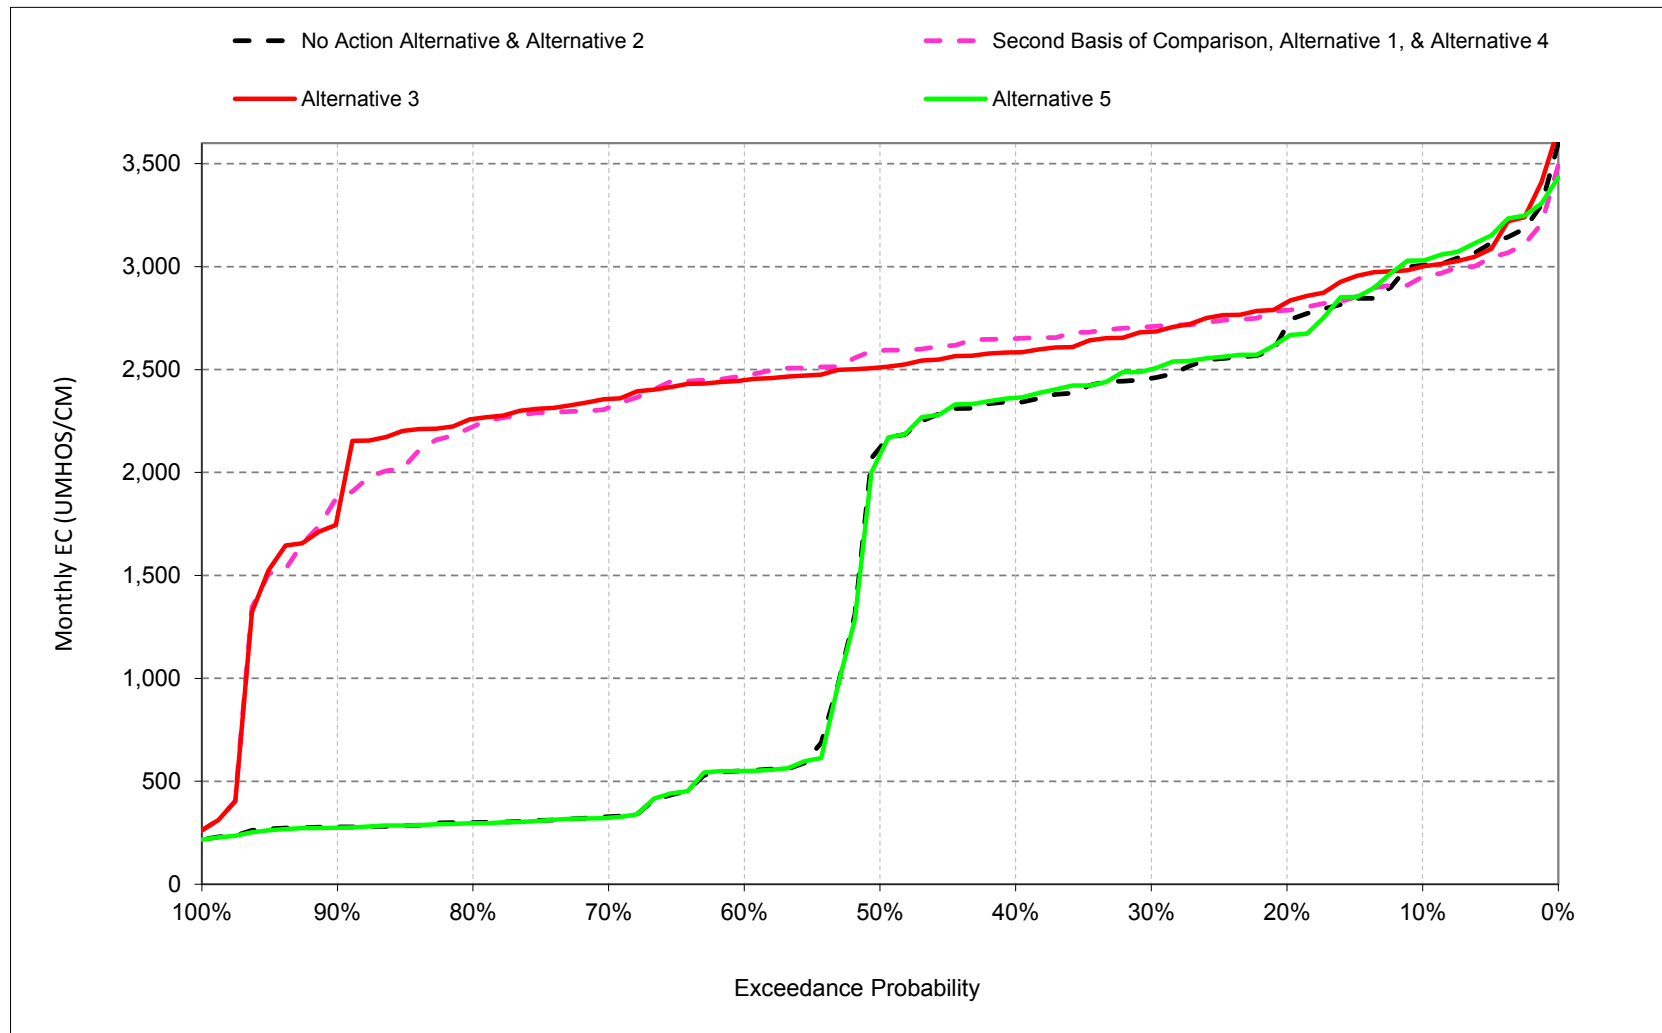


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.3.2. San Joaquin River at Jersey Point Salinity, Electrical Conductivity, November

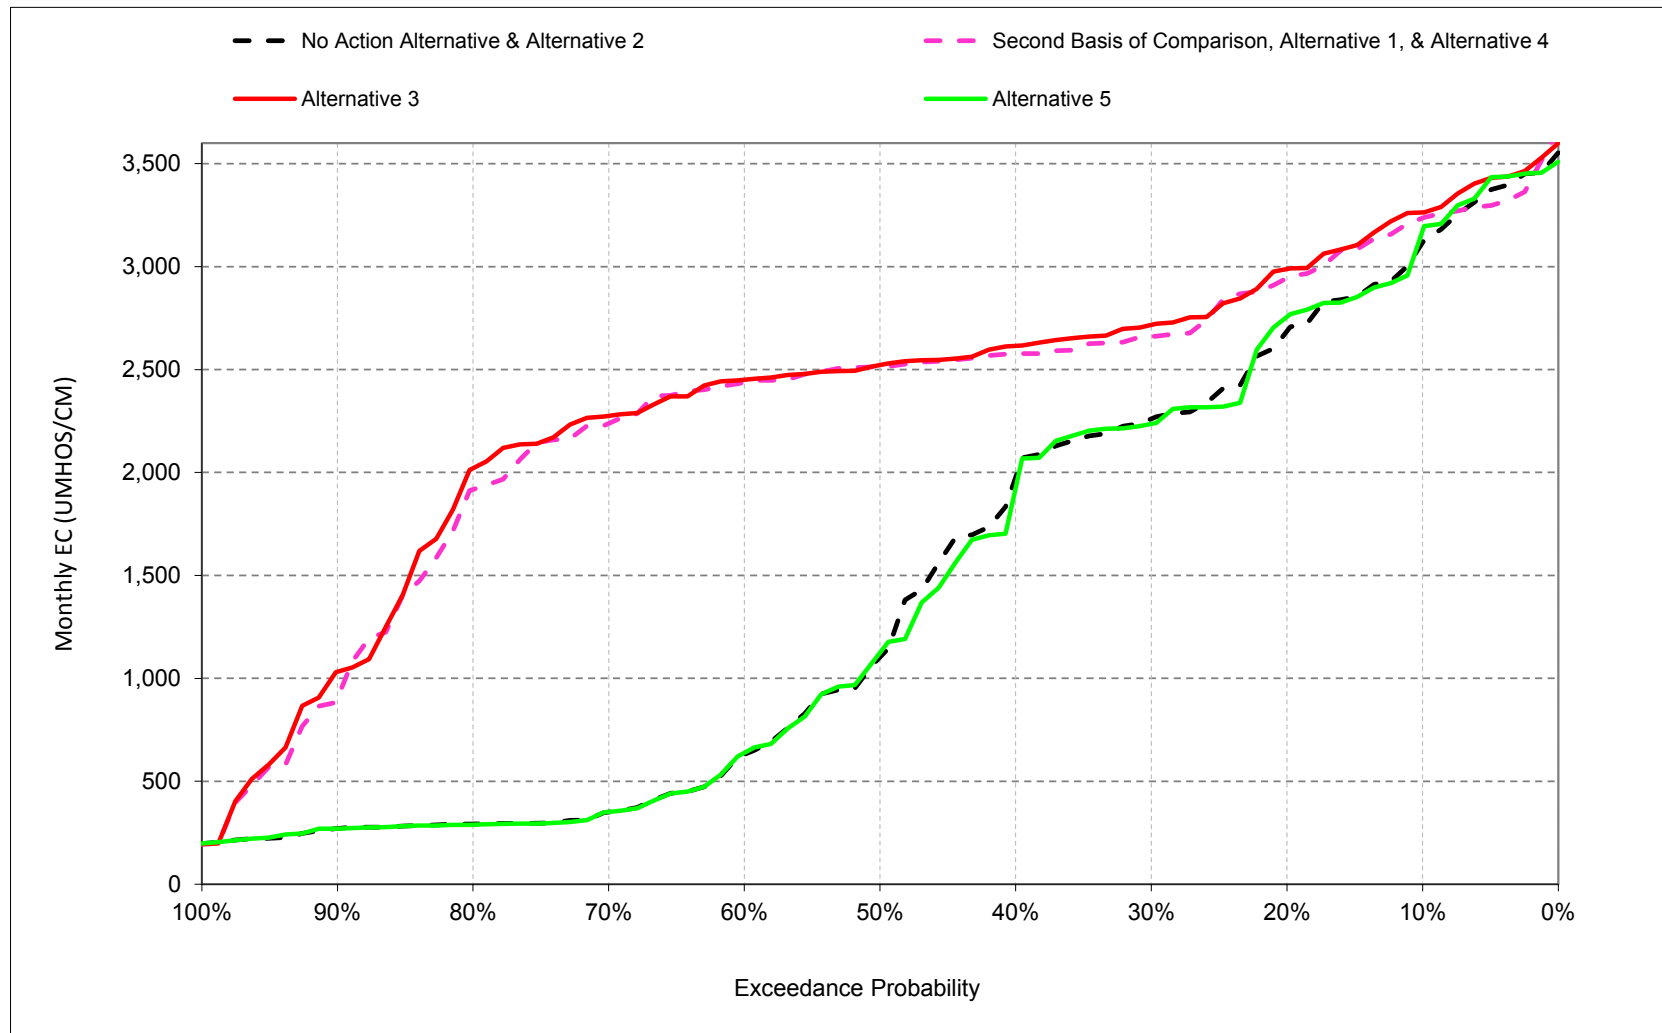


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.3.3. San Joaquin River at Jersey Point Salinity, Electrical Conductivity, December

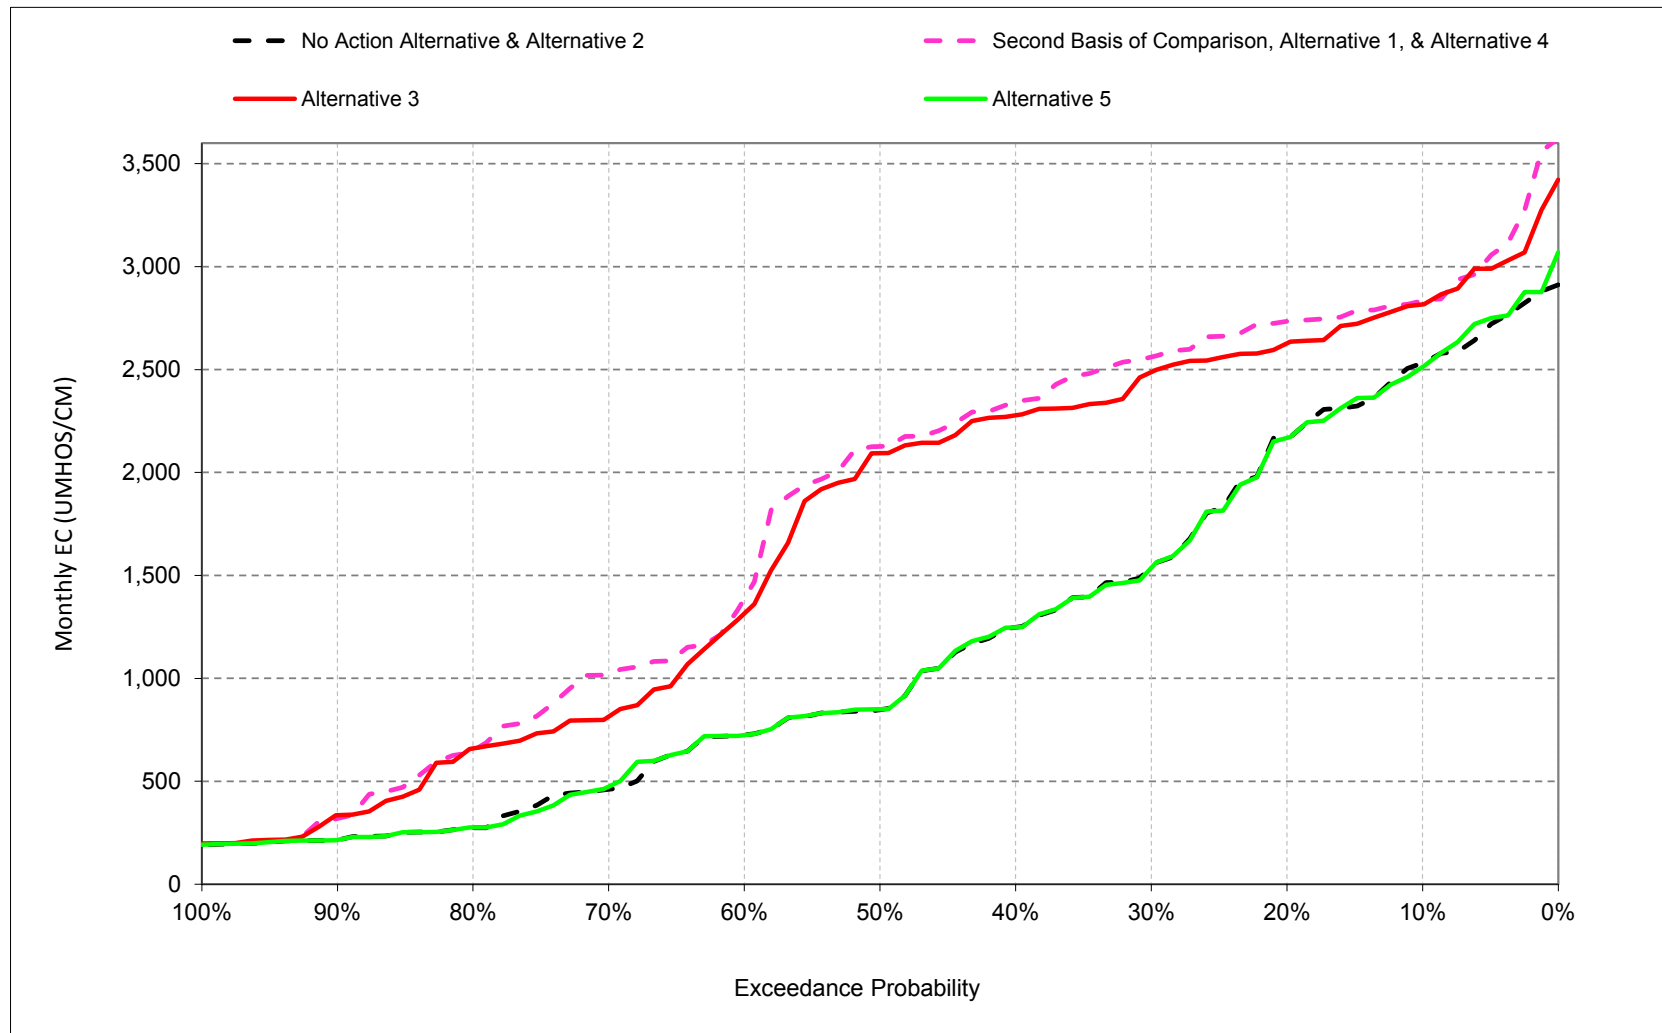


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.3.4. San Joaquin River at Jersey Point Salinity, Electrical Conductivity, January

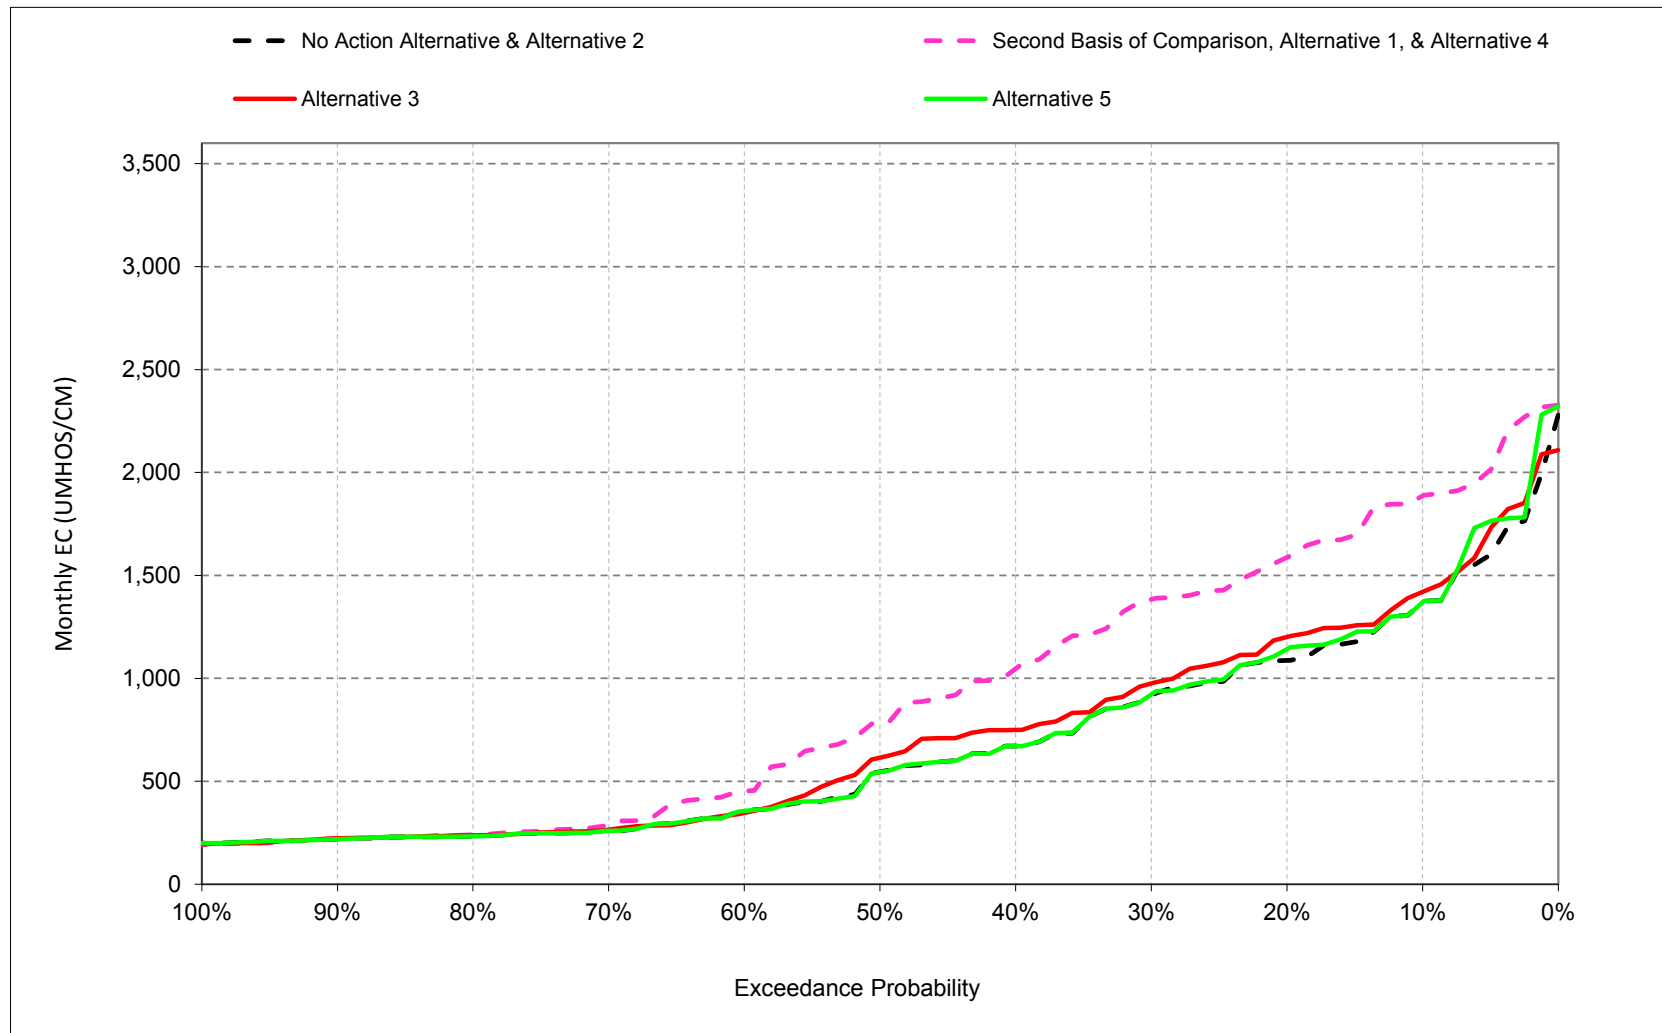


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.3.5. San Joaquin River at Jersey Point Salinity, Electrical Conductivity, February

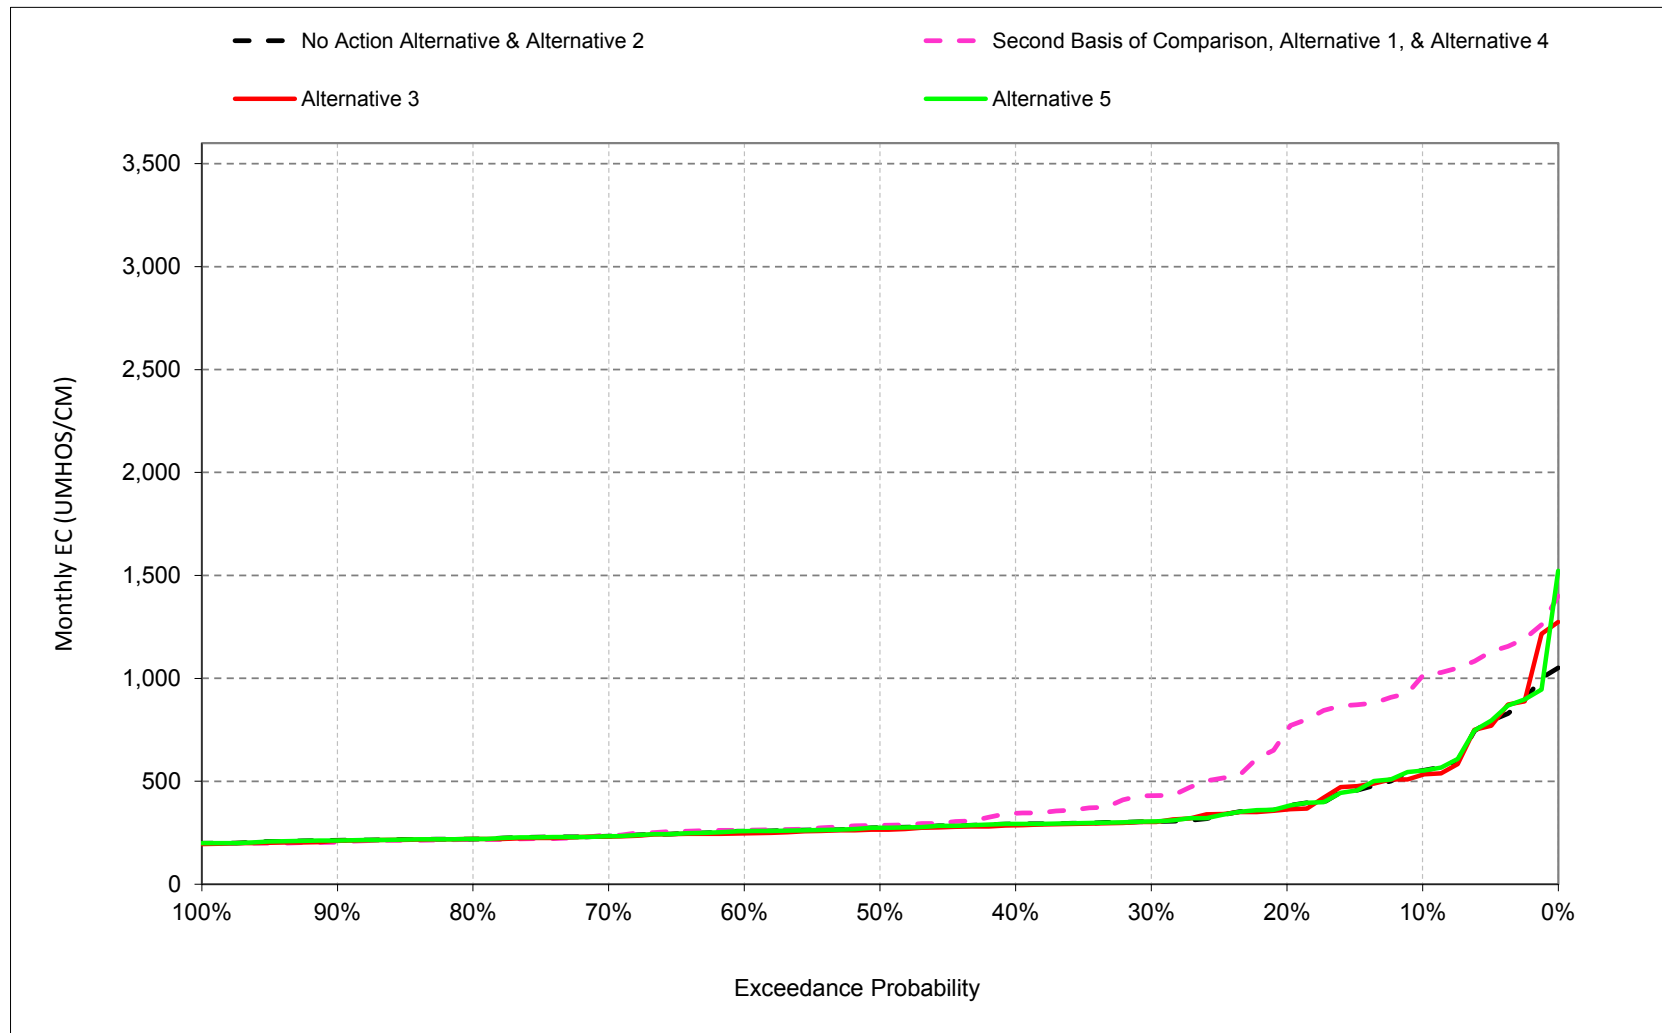


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.3.6. San Joaquin River at Jersey Point Salinity, Electrical Conductivity, March

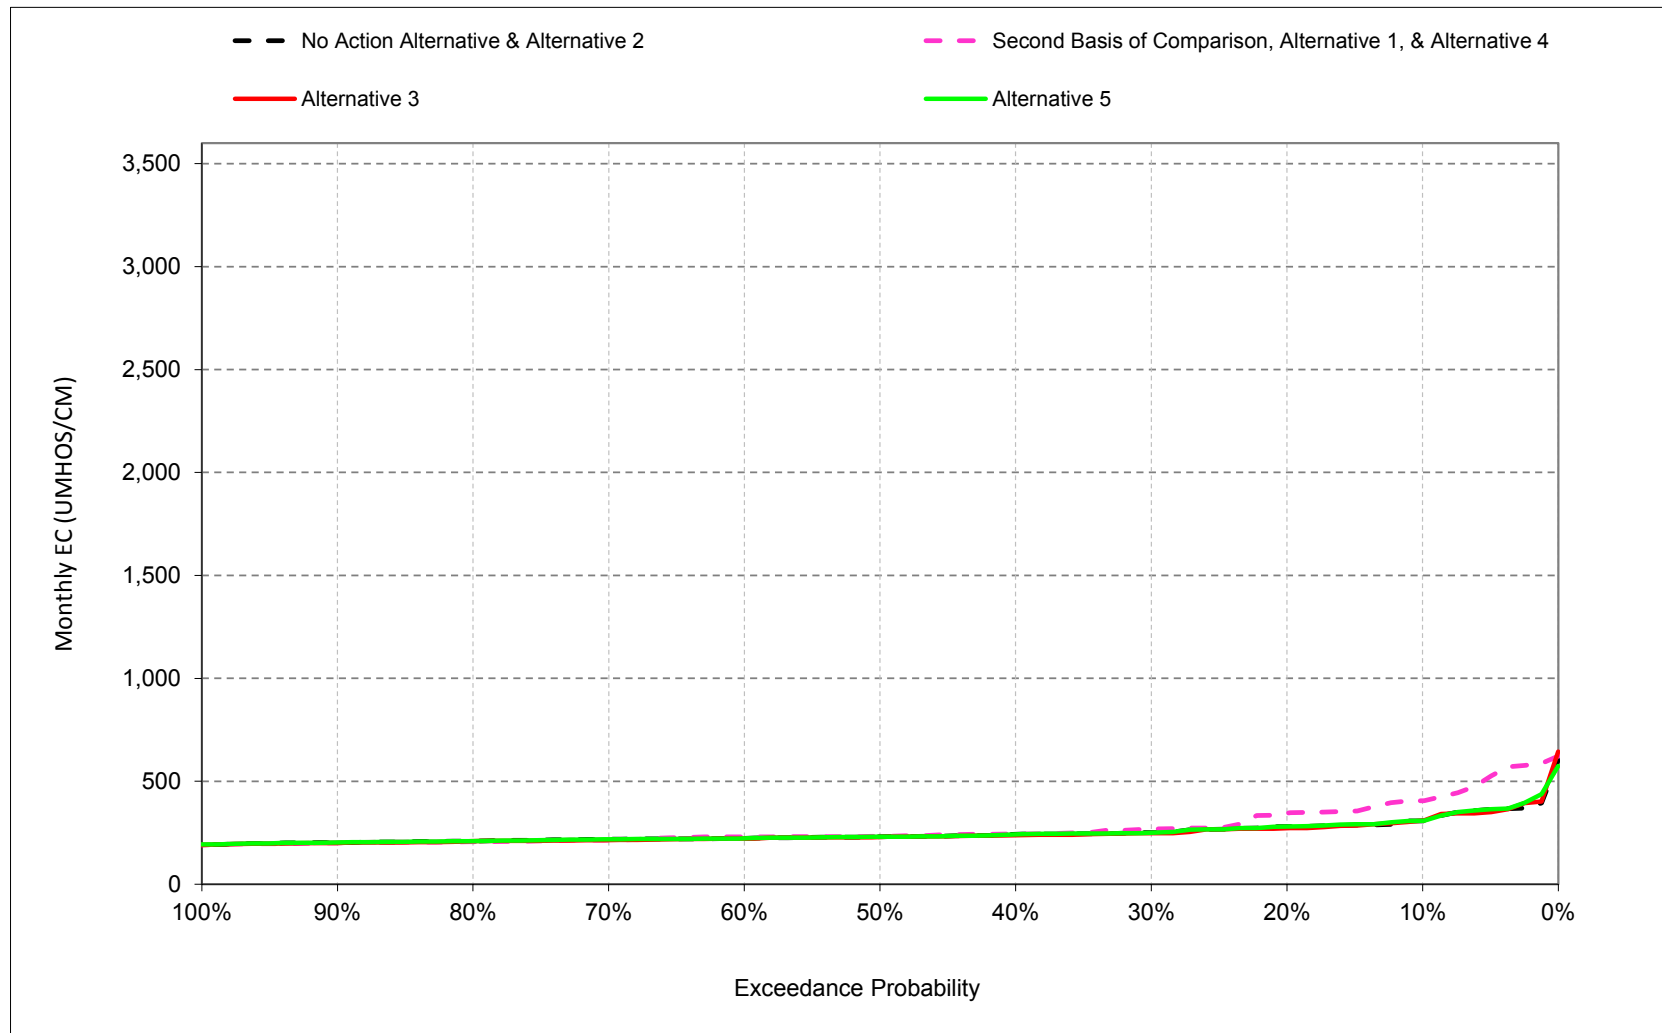


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.3.7. San Joaquin River at Jersey Point Salinity, Electrical Conductivity, April

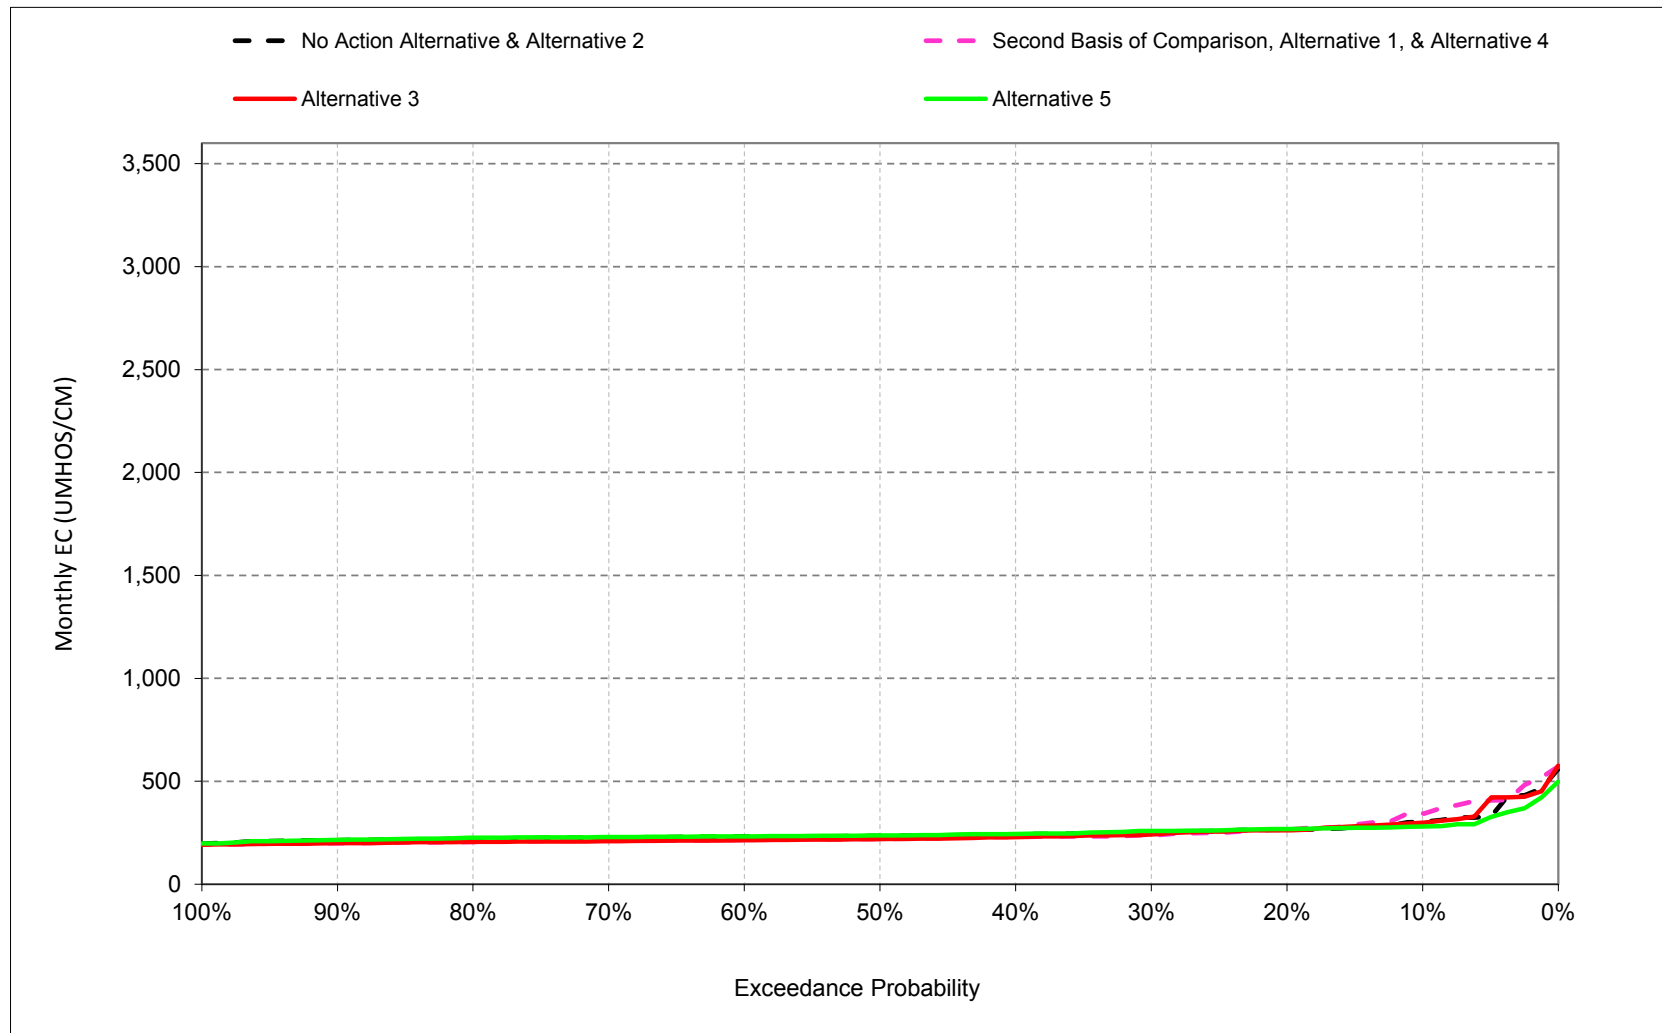


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.3.8. San Joaquin River at Jersey Point Salinity, Electrical Conductivity, May

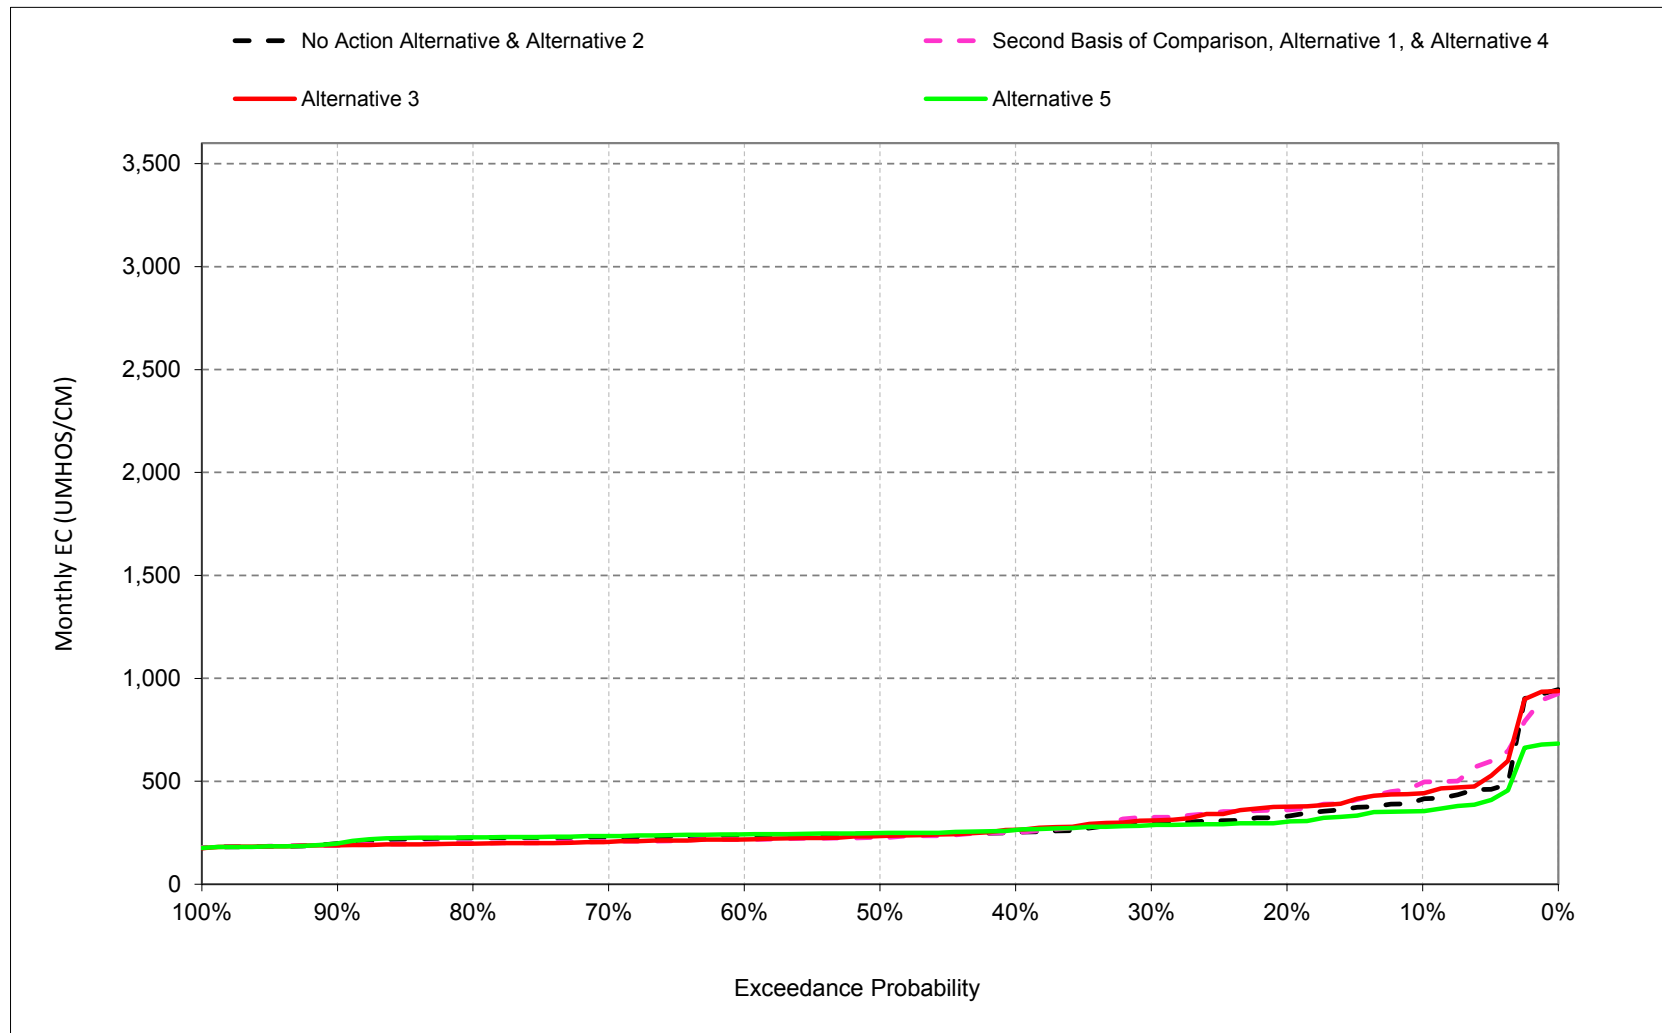


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.3.9. San Joaquin River at Jersey Point Salinity, Electrical Conductivity, June

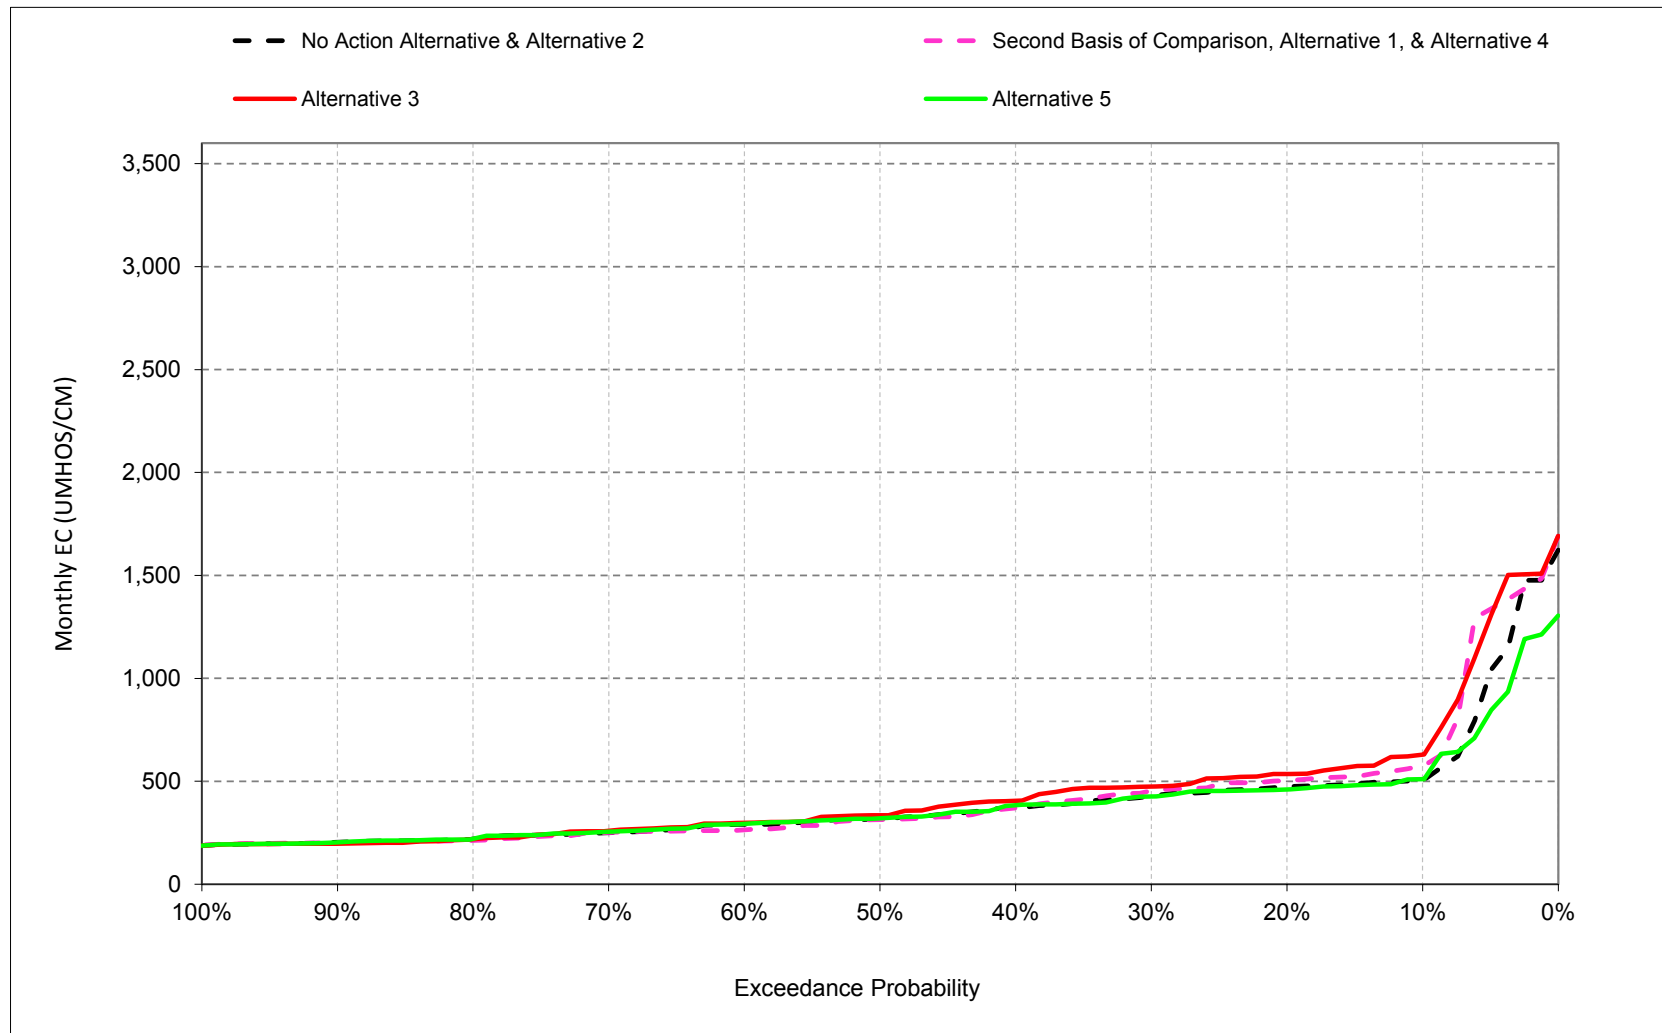


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.3.10. San Joaquin River at Jersey Point Salinity, Electrical Conductivity, July

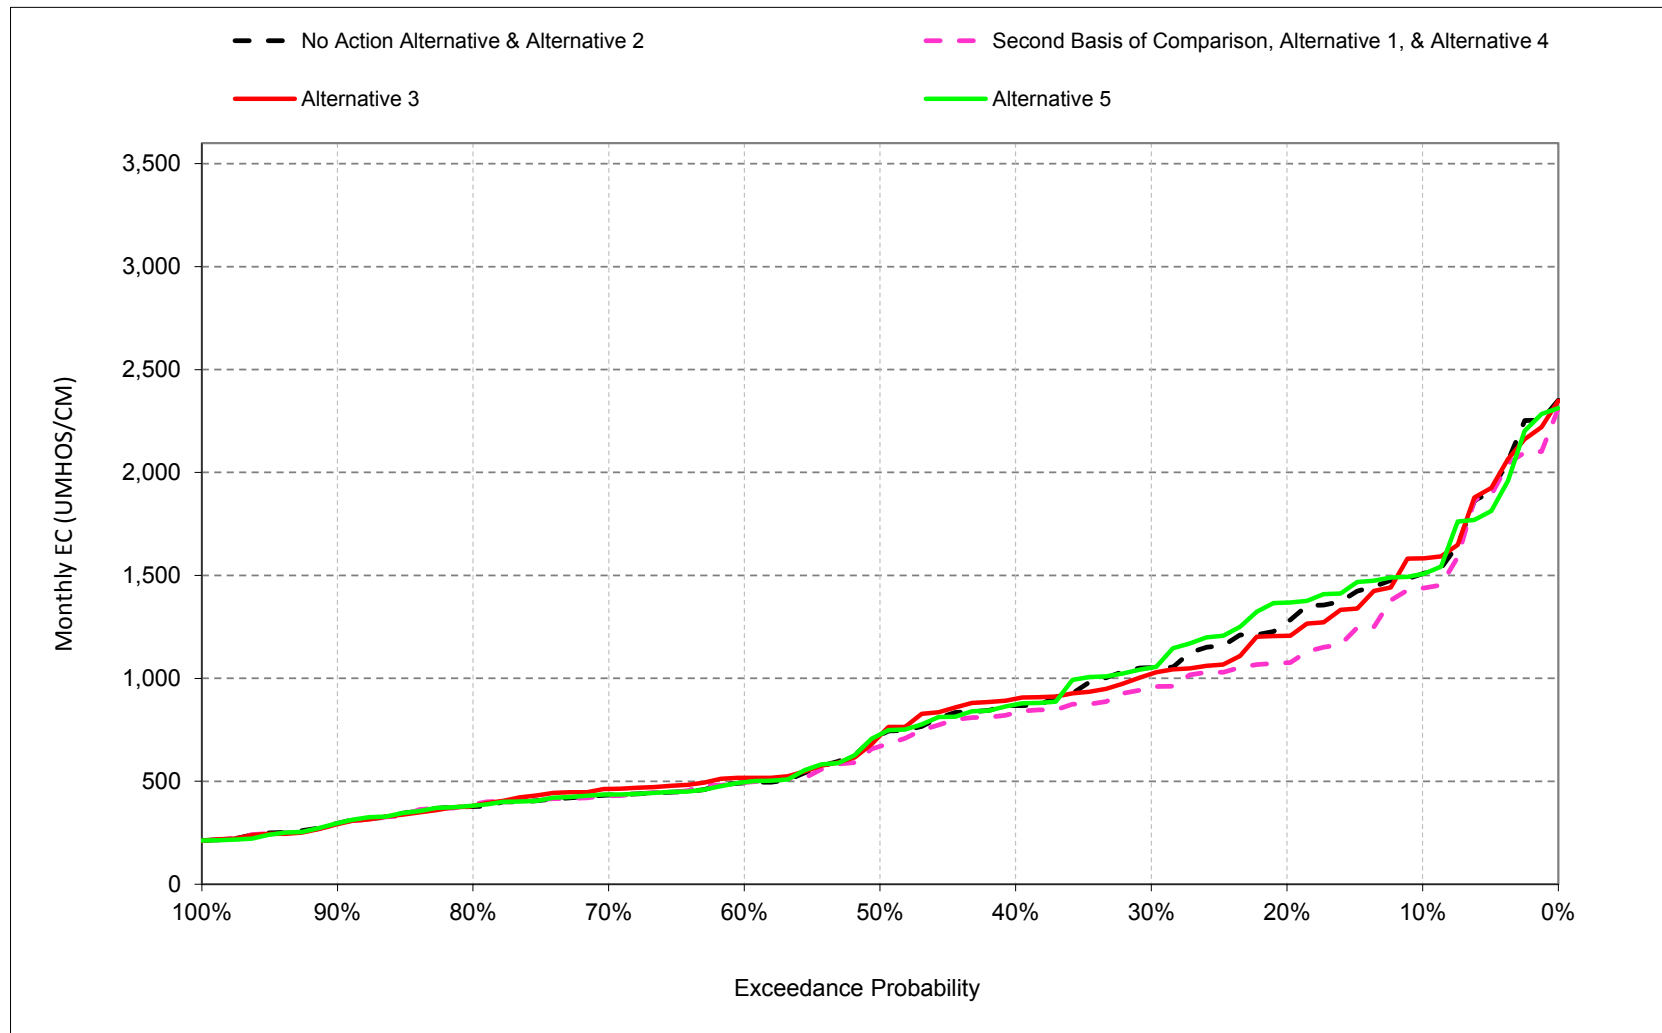


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.3.11. San Joaquin River at Jersey Point Salinity, Electrical Conductivity, August

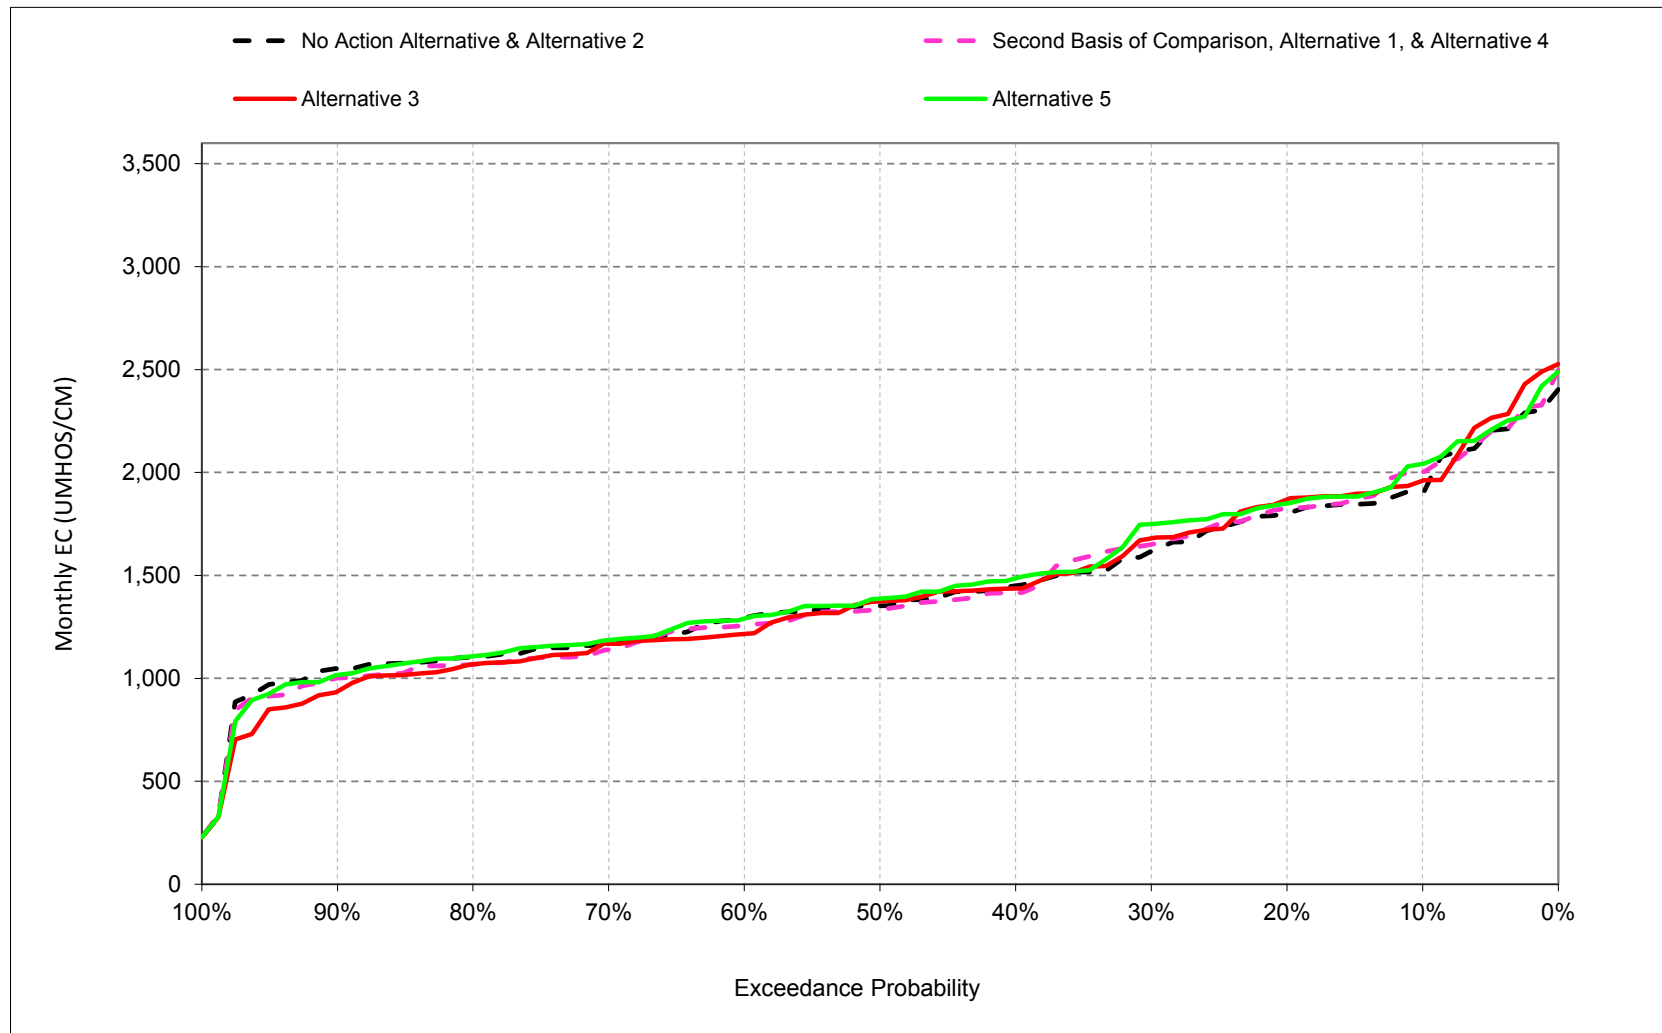

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.3.12. San Joaquin River at Jersey Point Salinity, Electrical Conductivity, September

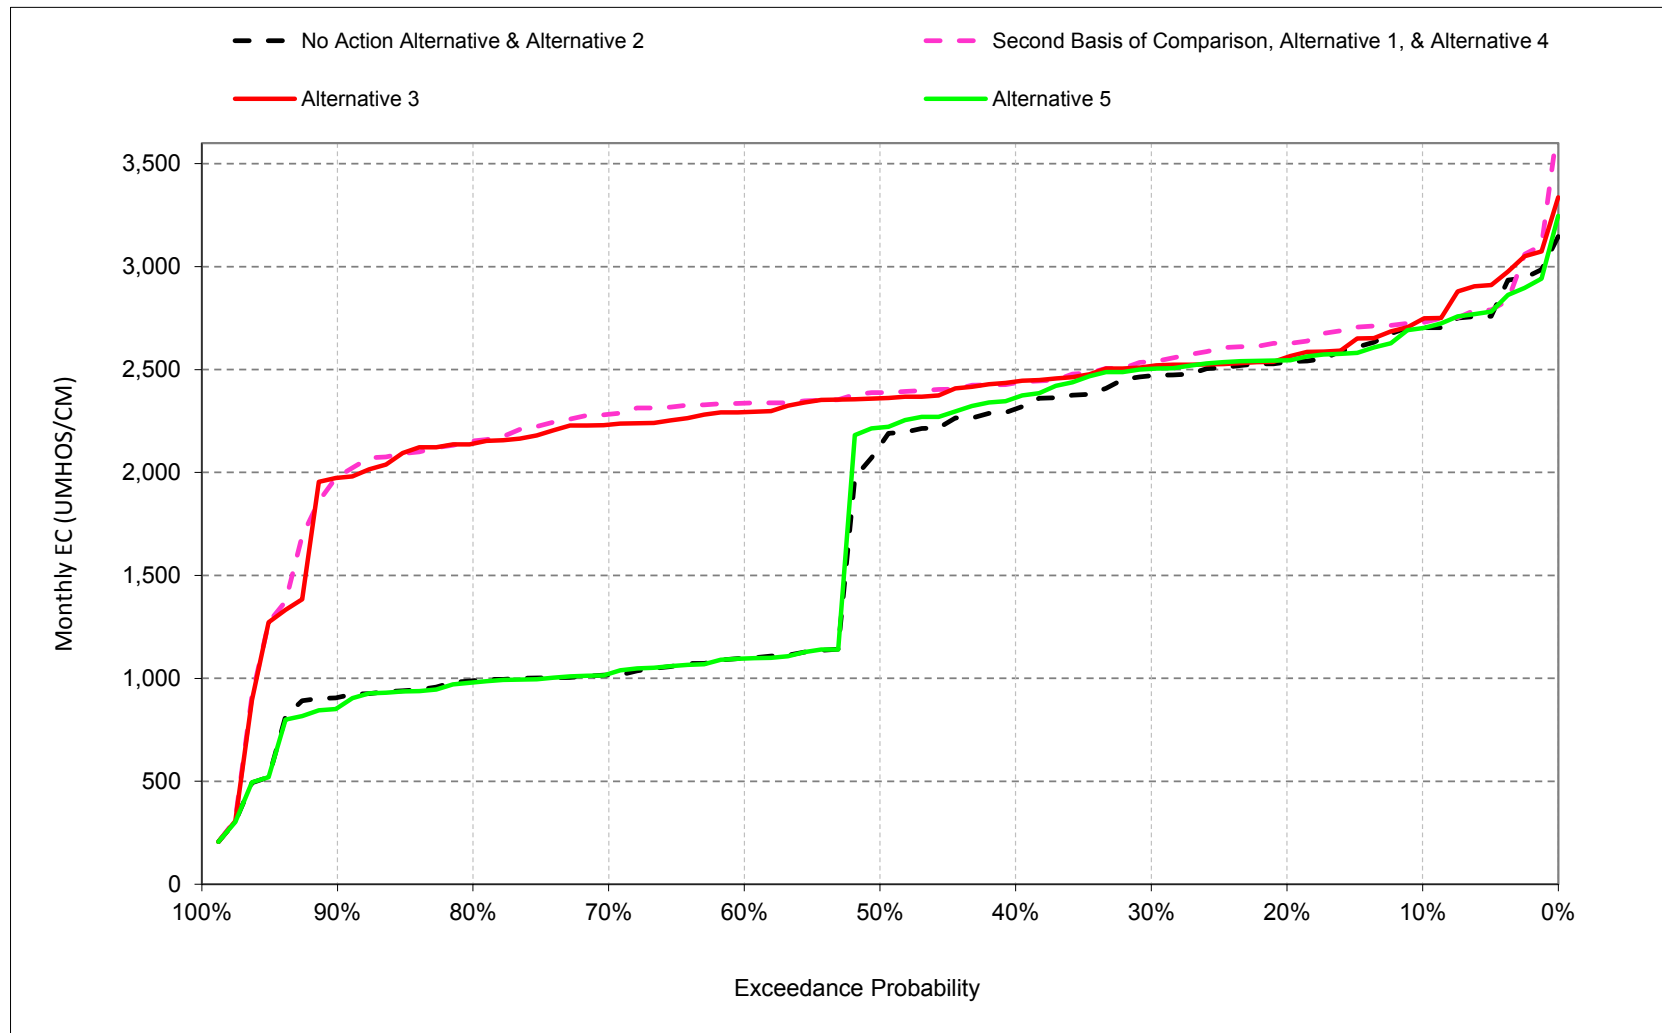

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.3.1. San Joaquin River at Jersey Point Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3,007	3,116	2,532	1,369	552	308	303	413	508	1,509	1,909	2,703
20%	2,714	2,686	2,171	1,087	379	280	265	330	474	1,272	1,802	2,537
30%	2,458	2,260	1,540	915	304	251	253	294	429	1,053	1,617	2,470
40%	2,342	1,975	1,248	671	293	242	242	252	373	867	1,450	2,309
50%	2,121	1,104	848	546	275	231	234	243	317	724	1,353	2,131
60%	551	631	725	355	258	223	231	238	290	492	1,293	1,097
70%	328	350	461	259	233	218	226	228	250	433	1,167	1,016
80%	299	293	274	233	219	210	220	225	219	377	1,104	995
90%	278	270	214	219	213	202	214	198	204	295	1,047	924
Long Term												
Full Simulation Period ^b	1,547	1,452	1,168	674	334	249	253	292	398	833	1,429	1,762
Water Year Types ^c												
Wet (32%)	1,075	917	488	284	236	220	223	214	238	352	1,085	906
Above Normal (16%)	2,065	1,629	1,061	461	253	218	232	238	302	462	1,168	1,023
Below Normal (13%)	1,065	1,117	1,155	696	330	247	249	275	373	793	1,421	2,422
Dry (24%)	1,617	1,634	1,576	950	395	260	249	291	407	1,251	1,669	2,464
Critical (15%)	2,335	2,424	2,088	1,270	538	332	348	541	856	1,617	2,060	2,643
Alternative 1												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	2,951	3,235	2,834	1,886	1,012	405	344	494	576	1,438	2,003	2,729
20%	2,789	2,945	2,734	1,587	747	345	266	361	503	1,075	1,825	2,628
30%	2,708	2,660	2,560	1,383	430	268	238	324	454	955	1,650	2,539
40%	2,651	2,577	2,340	1,047	344	244	230	252	370	833	1,416	2,435
50%	2,592	2,514	2,127	782	286	233	220	227	313	670	1,335	2,388
60%	2,471	2,437	1,386	452	262	230	215	218	263	494	1,258	2,336
70%	2,315	2,238	1,023	290	238	215	212	208	252	429	1,139	2,283
80%	2,222	1,917	648	240	217	207	205	200	213	388	1,067	2,162
90%	1,874	903	319	221	204	200	199	189	202	292	1,001	2,028
Long Term												
Full Simulation Period ^b	2,438	2,323	1,788	916	442	275	249	298	418	785	1,422	2,337
Water Year Types ^c												
Wet (32%)	2,232	2,126	939	330	234	220	211	203	229	350	1,034	1,951
Above Normal (16%)	2,643	2,234	1,760	746	307	218	209	219	287	463	1,159	2,348
Below Normal (13%)	2,326	2,133	1,944	1,320	577	293	248	298	394	802	1,409	2,421
Dry (24%)	2,485	2,483	2,323	1,276	558	290	247	308	443	1,079	1,696	2,569
Critical (15%)	2,688	2,756	2,623	1,400	725	416	378	574	954	1,571	2,104	2,696
Alternative 1 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-56	119	302	517	460	98	40	81	68	-71	94	26
20%	74	259	562	500	368	64	1	31	29	-197	23	91
30%	251	400	1,021	468	126	17	-15	31	25	-97	34	68
40%	308	601	1,092	375	52	2	-12	0	-2	-34	-34	126
50%	471	1,410	1,279	236	11	2	-14	-17	-4	-54	-18	257
60%	1,920	1,806	662	96	5	7	-15	-21	-27	2	-35	1,239
70%	1,987	1,888	562	31	5	-3	-14	-20	2	-3	-27	1,267
80%	1,923	1,624	374	8	-2	-3	-14	-25	-6	10	-37	1,168
90%	1,595	633	104	1	-9	-2	-15	-9	-1	-3	-46	1,104
Long Term												
Full Simulation Period ^b	891	871	620	242	108	26	-4	6	20	-48	-6	574
Water Year Types ^c												
Wet (32%)	1,157	1,209	450	46	-2	0	-12	-11	-9	-2	-51	1,044
Above Normal (16%)	577	605	699	285	54	0	-23	-19	-15	1	-10	1,325
Below Normal (13%)	1,261	1,016	789	624	247	45	-1	23	21	9	-12	-1
Dry (24%)	867	849	747	326	163	31	-2	18	35	-172	26	105
Critical (15%)	353	332	536	130	187	84	30	33	98	-47	44	54

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
b Based on the 82-year simulation period.
c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.3.2. San Joaquin River at Jersey Point Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3,007	3,116	2,532	1,369	552	308	303	413	508	1,509	1,909	2,703
20%	2,714	2,686	2,171	1,087	379	280	265	330	474	1,272	1,802	2,537
30%	2,458	2,260	1,540	915	304	251	253	294	429	1,053	1,617	2,470
40%	2,342	1,975	1,248	671	293	242	242	252	373	867	1,450	2,309
50%	2,121	1,104	848	546	275	231	234	243	317	724	1,353	2,131
60%	551	631	725	355	258	223	231	238	290	492	1,293	1,097
70%	328	350	461	259	233	218	226	228	250	433	1,167	1,016
80%	299	293	274	233	219	210	220	225	219	377	1,104	995
90%	278	270	214	219	213	202	214	198	204	295	1,047	924
Long Term												
Full Simulation Period ^b	1,547	1,452	1,168	674	334	249	253	292	398	833	1,429	1,762
Water Year Types ^c												
Wet (32%)	1,075	917	488	284	236	220	223	214	238	352	1,085	906
Above Normal (16%)	2,065	1,629	1,061	461	253	218	232	238	302	462	1,168	1,023
Below Normal (13%)	1,065	1,117	1,155	696	330	247	249	275	373	793	1,421	2,422
Dry (24%)	1,617	1,634	1,576	950	395	260	249	291	407	1,251	1,669	2,464
Critical (15%)	2,335	2,424	2,088	1,270	538	332	348	541	856	1,617	2,060	2,643

Alternative 3												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3,000	3,264	2,817	1,420	531	309	299	442	629	1,583	1,959	2,745
20%	2,826	2,989	2,627	1,201	363	272	262	376	536	1,207	1,869	2,559
30%	2,684	2,717	2,487	974	302	248	242	309	474	1,021	1,680	2,517
40%	2,583	2,615	2,277	750	286	238	228	264	405	901	1,436	2,442
50%	2,510	2,522	2,094	615	265	229	219	234	335	722	1,374	2,360
60%	2,448	2,450	1,315	347	246	221	214	218	298	516	1,216	2,297
70%	2,357	2,275	814	265	231	214	209	206	260	463	1,168	2,238
80%	2,260	2,021	659	237	220	209	205	197	218	380	1,069	2,154
90%	1,786	1,032	335	223	210	201	199	189	197	291	937	1,984
Long Term												
Full Simulation Period ^b	2,455	2,358	1,709	713	337	248	243	296	442	831	1,420	2,311
Water Year Types ^c												
Wet (32%)	2,213	2,168	893	303	233	218	209	203	247	360	996	1,901
Above Normal (16%)	2,755	2,312	1,652	532	250	213	209	219	309	478	1,156	2,328
Below Normal (13%)	2,323	2,126	1,949	863	348	247	242	294	443	854	1,458	2,437
Dry (24%)	2,504	2,538	2,278	964	386	258	243	306	477	1,199	1,702	2,528
Critical (15%)	2,694	2,737	2,370	1,243	561	334	355	567	952	1,597	2,120	2,701

Alternative 3 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-7	147	285	51	-21	2	-4	29	121	75	50	42
20%	112	303	456	113	-16	-8	-3	46	62	-66	67	22
30%	226	457	947	59	-2	-3	-11	15	45	-31	63	47
40%	241	640	1,030	78	-7	-4	-14	12	33	34	-14	133
50%	389	1,418	1,246	69	-10	-2	-15	-10	18	-2	21	228
60%	1,897	1,820	591	-8	-11	-1	-17	-21	8	24	-77	1,199
70%	2,029	1,924	353	6	-2	-4	-18	-22	10	30	1	1,222
80%	1,960	1,729	385	4	0	-1	-14	-28	-1	3	-35	1,160
90%	1,507	762	120	4	-2	-2	-15	-9	-7	-4	-111	1,060
Long Term												
Full Simulation Period ^b	908	906	541	39	2	-2	-9	4	44	-2	-9	548
Water Year Types ^c												
Wet (32%)	1,138	1,250	405	19	-3	-2	-14	-11	9	8	-89	995
Above Normal (16%)	689	683	591	71	-3	-4	-23	-18	7	15	-12	1,305
Below Normal (13%)	1,258	1,009	794	168	18	0	-7	19	71	62	37	14
Dry (24%)	887	904	702	14	-9	-2	-6	15	70	-52	32	64
Critical (15%)	359	313	282	-26	24	2	7	26	96	-20	59	58

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.3.3. San Joaquin River at Jersey Point Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3,007	3,116	2,532	1,369	552	308	303	413	508	1,509	1,909	2,703
20%	2,714	2,686	2,171	1,087	379	280	265	330	474	1,272	1,802	2,537
30%	2,458	2,260	1,540	915	304	251	253	294	429	1,053	1,617	2,470
40%	2,342	1,975	1,248	671	293	242	242	252	373	867	1,450	2,309
50%	2,121	1,104	848	546	275	231	234	243	317	724	1,353	2,131
60%	551	631	725	355	258	223	231	238	290	492	1,293	1,097
70%	328	350	461	259	233	218	226	228	250	433	1,167	1,016
80%	299	293	274	233	219	210	220	225	219	377	1,104	995
90%	278	270	214	219	213	202	214	198	204	295	1,047	924
Long Term												
Full Simulation Period ^b	1,547	1,452	1,168	674	334	249	253	292	398	833	1,429	1,762
Water Year Types ^c												
Wet (32%)	1,075	917	488	284	236	220	223	214	238	352	1,085	906
Above Normal (16%)	2,065	1,629	1,061	461	253	218	232	238	302	462	1,168	1,023
Below Normal (13%)	1,065	1,117	1,155	696	330	247	249	275	373	793	1,421	2,422
Dry (24%)	1,617	1,634	1,576	950	395	260	249	291	407	1,251	1,669	2,464
Critical (15%)	2,335	2,424	2,088	1,270	538	332	348	541	856	1,617	2,060	2,643

Alternative 5												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3,030	3,172	2,512	1,369	552	308	281	355	510	1,507	2,042	2,701
20%	2,657	2,756	2,168	1,141	379	280	269	304	460	1,368	1,849	2,544
30%	2,502	2,236	1,537	922	304	250	258	287	426	1,052	1,749	2,503
40%	2,363	1,922	1,248	671	293	242	244	263	383	873	1,485	2,363
50%	2,086	1,124	850	544	274	231	237	248	320	728	1,387	2,218
60%	550	638	724	355	258	223	233	242	293	495	1,290	1,096
70%	323	351	474	259	233	218	229	234	255	435	1,186	1,021
80%	295	289	275	233	219	210	226	227	220	381	1,107	988
90%	274	270	215	219	213	202	216	198	204	297	1,017	906
Long Term												
Full Simulation Period ^b	1,552	1,448	1,171	686	340	250	250	277	383	842	1,453	1,775
Water Year Types ^c												
Wet (32%)	1,078	948	493	284	236	220	223	215	240	352	1,079	898
Above Normal (16%)	2,090	1,576	1,047	460	253	218	233	241	305	465	1,163	1,020
Below Normal (13%)	1,068	1,121	1,152	697	329	247	251	272	375	800	1,423	2,443
Dry (24%)	1,617	1,610	1,593	967	398	260	252	287	409	1,296	1,740	2,503
Critical (15%)	2,333	2,420	2,088	1,321	576	337	320	441	742	1,592	2,129	2,667

Alternative 5 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	23	56	-19	1	0	0	-23	-58	2	-1	133	-2
20%	-57	70	-3	54	0	0	4	-27	-14	96	47	8
30%	44	-24	-3	7	0	-1	5	-7	-3	-1	133	33
40%	20	-54	0	-1	0	0	2	11	11	6	35	54
50%	-35	20	2	-1	-1	0	2	5	3	4	35	87
60%	-1	7	0	0	0	0	2	4	3	3	-3	-1
70%	-5	1	12	0	0	0	3	6	5	3	19	5
80%	-4	-4	1	0	0	0	6	3	1	4	4	-7
90%	-4	-1	0	0	0	0	2	0	0	2	-30	-17
Long Term												
Full Simulation Period ^b	5	-5	3	12	6	1	-3	-15	-15	9	25	13
Water Year Types ^c												
Wet (32%)	3	31	4	0	0	0	0	1	2	0	-6	-8
Above Normal (16%)	24	-54	-14	-1	0	0	1	4	3	2	-5	-3
Below Normal (13%)	3	4	-3	1	0	0	2	-3	3	7	2	20
Dry (24%)	0	-23	16	17	3	0	3	-4	1	45	70	40
Critical (15%)	-2	-4	0	51	38	5	-28	-100	-114	-26	69	25

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.3.4. San Joaquin River at Jersey Point Salinity, Monthly EC

Second Basis of Comparison												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,951	3,235	2,834	1,886	1,012	405	344	494	576	1,438	2,003	2,729
20%	2,789	2,945	2,734	1,587	747	345	266	361	503	1,075	1,825	2,628
30%	2,708	2,660	2,560	1,383	430	268	238	324	454	955	1,650	2,539
40%	2,651	2,577	2,340	1,047	344	244	230	252	370	833	1,416	2,435
50%	2,592	2,514	2,127	782	286	233	220	227	313	670	1,335	2,388
60%	2,471	2,437	1,386	452	262	230	215	218	263	494	1,258	2,336
70%	2,315	2,238	1,023	290	238	215	212	208	252	429	1,139	2,283
80%	2,222	1,917	648	240	217	207	205	200	213	388	1,067	2,162
90%	1,874	903	319	221	204	200	199	189	202	292	1,001	2,028
Long Term												
Full Simulation Period ^b	2,438	2,323	1,788	916	442	275	249	298	418	785	1,422	2,337
Water Year Types^c												
Wet (32%)	2,232	2,126	939	330	234	220	211	203	229	350	1,034	1,951
Above Normal (16%)	2,643	2,234	1,760	746	307	218	209	219	287	463	1,159	2,348
Below Normal (13%)	2,326	2,133	1,944	1,320	577	293	248	298	394	802	1,409	2,421
Dry (24%)	2,485	2,483	2,323	1,276	558	290	247	308	443	1,079	1,696	2,569
Critical (15%)	2,688	2,756	2,623	1,400	725	416	378	574	954	1,571	2,104	2,696
No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,007	3,116	2,532	1,369	552	308	303	413	508	1,509	1,909	2,703
20%	2,714	2,686	2,171	1,087	379	280	265	330	474	1,272	1,802	2,537
30%	2,458	2,260	1,540	915	304	251	253	294	429	1,053	1,617	2,470
40%	2,342	1,975	1,248	671	293	242	242	252	373	867	1,450	2,309
50%	2,121	1,104	848	546	275	231	234	243	317	724	1,353	2,131
60%	551	631	725	355	258	223	231	238	290	492	1,293	1,097
70%	328	350	461	259	233	218	226	228	250	433	1,167	1,016
80%	299	293	274	233	219	210	220	225	219	377	1,104	995
90%	278	270	214	219	213	202	214	198	204	295	1,047	924
Long Term												
Full Simulation Period ^b	1,547	1,452	1,168	674	334	249	253	292	398	833	1,429	1,762
Water Year Types^c												
Wet (32%)	1,075	917	488	284	236	220	223	214	238	352	1,085	906
Above Normal (16%)	2,065	1,629	1,061	461	253	218	232	238	302	462	1,168	1,023
Below Normal (13%)	1,065	1,117	1,155	696	330	247	249	275	373	793	1,421	2,422
Dry (24%)	1,617	1,634	1,576	950	395	260	249	291	407	1,251	1,669	2,464
Critical (15%)	2,335	2,424	2,088	1,270	538	332	348	541	856	1,617	2,060	2,643
No Action Alternative minus Second Basis of Comparison												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	56	-119	-302	-517	-460	-98	-40	-81	-68	71	-94	-26
20%	-74	-259	-562	-500	-368	-64	-1	-31	-29	197	-23	-91
30%	-251	-400	-1,021	-468	-126	-17	15	-31	-25	97	-34	-68
40%	-308	-601	-1,092	-375	-52	-2	12	0	2	34	34	-126
50%	-471	-1,410	-1,279	-236	-11	-2	14	17	4	54	18	-257
60%	-1,920	-1,806	-662	-96	-5	-7	15	21	27	-2	35	-1,239
70%	-1,987	-1,888	-562	-31	-5	3	14	20	-2	3	27	-1,267
80%	-1,923	-1,624	-374	-8	2	3	14	25	6	-10	37	-1,168
90%	-1,595	-633	-104	-1	9	2	15	9	1	3	46	-1,104
Long Term												
Full Simulation Period ^b	-891	-871	-620	-242	-108	-26	4	-6	-20	48	6	-574
Water Year Types^c												
Wet (32%)	-1,157	-1,209	-450	-46	2	0	12	11	9	2	51	-1,044
Above Normal (16%)	-577	-605	-699	-285	-54	0	23	19	15	-1	10	-1,325
Below Normal (13%)	-1,261	-1,016	-789	-624	-247	-45	1	-23	-21	-9	12	1
Dry (24%)	-867	-849	-747	-326	-163	-31	2	-18	-35	172	-26	-105
Critical (15%)	-353	-332	-536	-130	-187	-84	-30	-33	-98	47	-44	-54

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.3.5. San Joaquin River at Jersey Point Salinity, Monthly EC

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance^a												
10%	2,951	3,235	2,834	1,886	1,012	405	344	494	576	1,438	2,003	2,729
20%	2,789	2,945	2,734	1,587	747	345	266	361	503	1,075	1,825	2,628
30%	2,708	2,660	2,560	1,383	430	268	238	324	454	955	1,650	2,539
40%	2,651	2,577	2,340	1,047	344	244	230	252	370	833	1,416	2,435
50%	2,592	2,514	2,127	782	286	233	220	227	313	670	1,335	2,388
60%	2,471	2,437	1,386	452	262	230	215	218	263	494	1,258	2,336
70%	2,315	2,238	1,023	290	238	215	212	208	252	429	1,139	2,283
80%	2,222	1,917	648	240	217	207	205	200	213	388	1,067	2,162
90%	1,874	903	319	221	204	200	199	189	202	292	1,001	2,028
Long Term												
Full Simulation Period ^b	2,438	2,323	1,788	916	442	275	249	298	418	785	1,422	2,337
Water Year Types^c												
Wet (32%)	2,232	2,126	939	330	234	220	211	203	229	350	1,034	1,951
Above Normal (16%)	2,643	2,234	1,760	746	307	218	209	219	287	463	1,159	2,348
Below Normal (13%)	2,326	2,133	1,944	1,320	577	293	248	298	394	802	1,409	2,421
Dry (24%)	2,485	2,483	2,323	1,276	558	290	247	308	443	1,079	1,696	2,569
Critical (15%)	2,688	2,756	2,623	1,400	725	416	378	574	954	1,571	2,104	2,696

Alternative 3

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	3,000	3,264	2,817	1,420	531	309	299	442	629	1,583	1,959	2,745
20%	2,826	2,989	2,627	1,201	363	272	262	376	536	1,207	1,869	2,559
30%	2,684	2,717	2,487	974	302	248	242	309	474	1,021	1,680	2,517
40%	2,583	2,615	2,277	750	286	238	228	264	405	901	1,436	2,442
50%	2,510	2,522	2,094	615	265	229	219	234	335	722	1,374	2,360
60%	2,448	2,450	1,315	347	246	221	214	218	298	516	1,216	2,297
70%	2,357	2,275	814	265	231	214	209	206	260	463	1,168	2,238
80%	2,260	2,021	659	237	220	209	205	197	218	380	1,069	2,154
90%	1,786	1,032	335	223	210	201	199	189	197	291	937	1,984
Long Term												
Full Simulation Period ^b	2,455	2,358	1,709	713	337	248	243	296	442	831	1,420	2,311
Water Year Types^c												
Wet (32%)	2,213	2,168	893	303	233	218	209	203	247	360	996	1,901
Above Normal (16%)	2,755	2,312	1,652	532	250	213	209	219	309	478	1,156	2,328
Below Normal (13%)	2,323	2,126	1,949	863	348	247	242	294	443	854	1,458	2,437
Dry (24%)	2,504	2,538	2,278	964	386	258	243	306	477	1,199	1,702	2,528
Critical (15%)	2,694	2,737	2,370	1,243	561	334	355	567	952	1,597	2,120	2,701

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	49	28	-17	-466	-480	-96	-45	-52	53	146	-44	16
20%	38	44	-107	-386	-384	-72	-4	15	33	132	44	-69
30%	-24	57	-73	-409	-128	-20	4	-15	20	66	29	-21
40%	-67	39	-63	-297	-58	-5	-2	12	35	68	20	7
50%	-82	7	-33	-168	-21	-4	-1	7	22	52	39	-28
60%	-23	13	-71	-105	-16	-9	-2	0	35	22	-42	-39
70%	42	36	-210	-25	-7	-1	-3	-2	8	33	28	-45
80%	37	104	11	-4	2	2	0	-3	5	-8	2	-8
90%	-88	129	16	2	7	0	0	0	-5	-1	-65	-44
Long Term												
Full Simulation Period ^b	17	35	-79	-203	-106	-27	-6	-2	24	46	-2	-26
Water Year Types^c												
Wet (32%)	-19	42	-46	-27	-1	-1	-2	1	18	10	-38	-49
Above Normal (16%)	112	78	-108	-214	-57	-4	0	1	22	14	-2	-20
Below Normal (13%)	-3	-7	5	-457	-229	-46	-6	-3	50	53	49	15
Dry (24%)	20	55	-45	-312	-171	-33	-4	-2	34	120	6	-41
Critical (15%)	6	-19	-254	-156	-163	-82	-23	-7	-2	27	15	5

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.3.6. San Joaquin River at Jersey Point Salinity, Monthly EC

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	2,951	3,235	2,834	1,886	1,012	405	344	494	576	1,438	2,003	2,729
20%	2,789	2,945	2,734	1,587	747	345	266	361	503	1,075	1,825	2,628
30%	2,708	2,660	2,560	1,383	430	268	238	324	454	955	1,650	2,539
40%	2,651	2,577	2,340	1,047	344	244	230	252	370	833	1,416	2,435
50%	2,592	2,514	2,127	782	286	233	220	227	313	670	1,335	2,388
60%	2,471	2,437	1,386	452	262	230	215	218	263	494	1,258	2,336
70%	2,315	2,238	1,023	290	238	215	212	208	252	429	1,139	2,283
80%	2,222	1,917	648	240	217	207	205	200	213	388	1,067	2,162
90%	1,874	903	319	221	204	200	199	189	202	292	1,001	2,028
Long Term												
Full Simulation Period ^b	2,438	2,323	1,788	916	442	275	249	298	418	785	1,422	2,337
Water Year Types ^c												
Wet (32%)	2,232	2,126	939	330	234	220	211	203	229	350	1,034	1,951
Above Normal (16%)	2,643	2,234	1,760	746	307	218	209	219	287	463	1,159	2,348
Below Normal (13%)	2,326	2,133	1,944	1,320	577	293	248	298	394	802	1,409	2,421
Dry (24%)	2,485	2,483	2,323	1,276	558	290	247	308	443	1,079	1,696	2,569
Critical (15%)	2,688	2,756	2,623	1,400	725	416	378	574	954	1,571	2,104	2,696

Alternative 5

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3,030	3,172	2,512	1,369	552	308	281	355	510	1,507	2,042	2,701
20%	2,657	2,756	2,168	1,141	379	280	269	304	460	1,368	1,849	2,544
30%	2,502	2,236	1,537	922	304	250	258	287	426	1,052	1,749	2,503
40%	2,363	1,922	1,248	671	293	242	244	263	383	873	1,485	2,363
50%	2,086	1,124	850	544	274	231	237	248	320	728	1,387	2,218
60%	550	638	724	355	258	223	233	242	293	495	1,290	1,096
70%	323	351	474	259	233	218	229	234	255	435	1,186	1,021
80%	295	289	275	233	219	210	226	227	220	381	1,107	988
90%	274	270	215	219	213	202	216	198	204	297	1,017	906
Long Term												
Full Simulation Period ^b	1,552	1,448	1,171	686	340	250	250	277	383	842	1,453	1,775
Water Year Types ^c												
Wet (32%)	1,078	948	493	284	236	220	223	215	240	352	1,079	898
Above Normal (16%)	2,090	1,576	1,047	460	253	218	233	241	305	465	1,163	1,020
Below Normal (13%)	1,068	1,121	1,152	697	329	247	251	272	375	800	1,423	2,443
Dry (24%)	1,617	1,610	1,593	967	398	260	252	287	409	1,296	1,740	2,503
Critical (15%)	2,333	2,420	2,088	1,321	576	337	320	441	742	1,592	2,129	2,667

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	79	-63	-322	-516	-460	-97	-63	-139	-66	70	38	-27
20%	-131	-189	-566	-446	-367	-65	3	-57	-43	293	24	-83
30%	-207	-425	-1,024	-461	-126	-18	20	-38	-28	96	99	-36
40%	-288	-655	-1,092	-376	-51	-2	14	11	13	40	69	-72
50%	-506	-1,390	-1,277	-238	-12	-2	17	22	7	58	53	-170
60%	-1,921	-1,799	-662	-96	-5	-7	17	24	30	1	33	-1,240
70%	-1,992	-1,887	-550	-31	-5	3	17	26	3	6	47	-1,261
80%	-1,927	-1,628	-373	-8	2	3	21	28	8	-6	40	-1,174
90%	-1,599	-633	-104	-2	9	2	17	10	1	5	16	-1,122
Long Term												
Full Simulation Period ^b	-886	-876	-617	-231	-102	-25	1	-21	-35	57	31	-562
Water Year Types ^c												
Wet (32%)	-1,154	-1,178	-446	-46	2	0	12	12	11	2	45	-1,053
Above Normal (16%)	-553	-659	-713	-286	-54	0	24	23	18	1	5	-1,328
Below Normal (13%)	-1,259	-1,012	-792	-624	-247	-46	3	-26	-19	-2	14	21
Dry (24%)	-867	-873	-731	-309	-160	-30	5	-22	-34	217	44	-65
Critical (15%)	-355	-336	-536	-79	-149	-79	-58	-133	-212	21	25	-29

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 **B.4. Sacramento River at Collinsville Salinity**

Figure 6E.B.4.1. Sacramento River at Collinsville Salinity, Electrical Conductivity, October

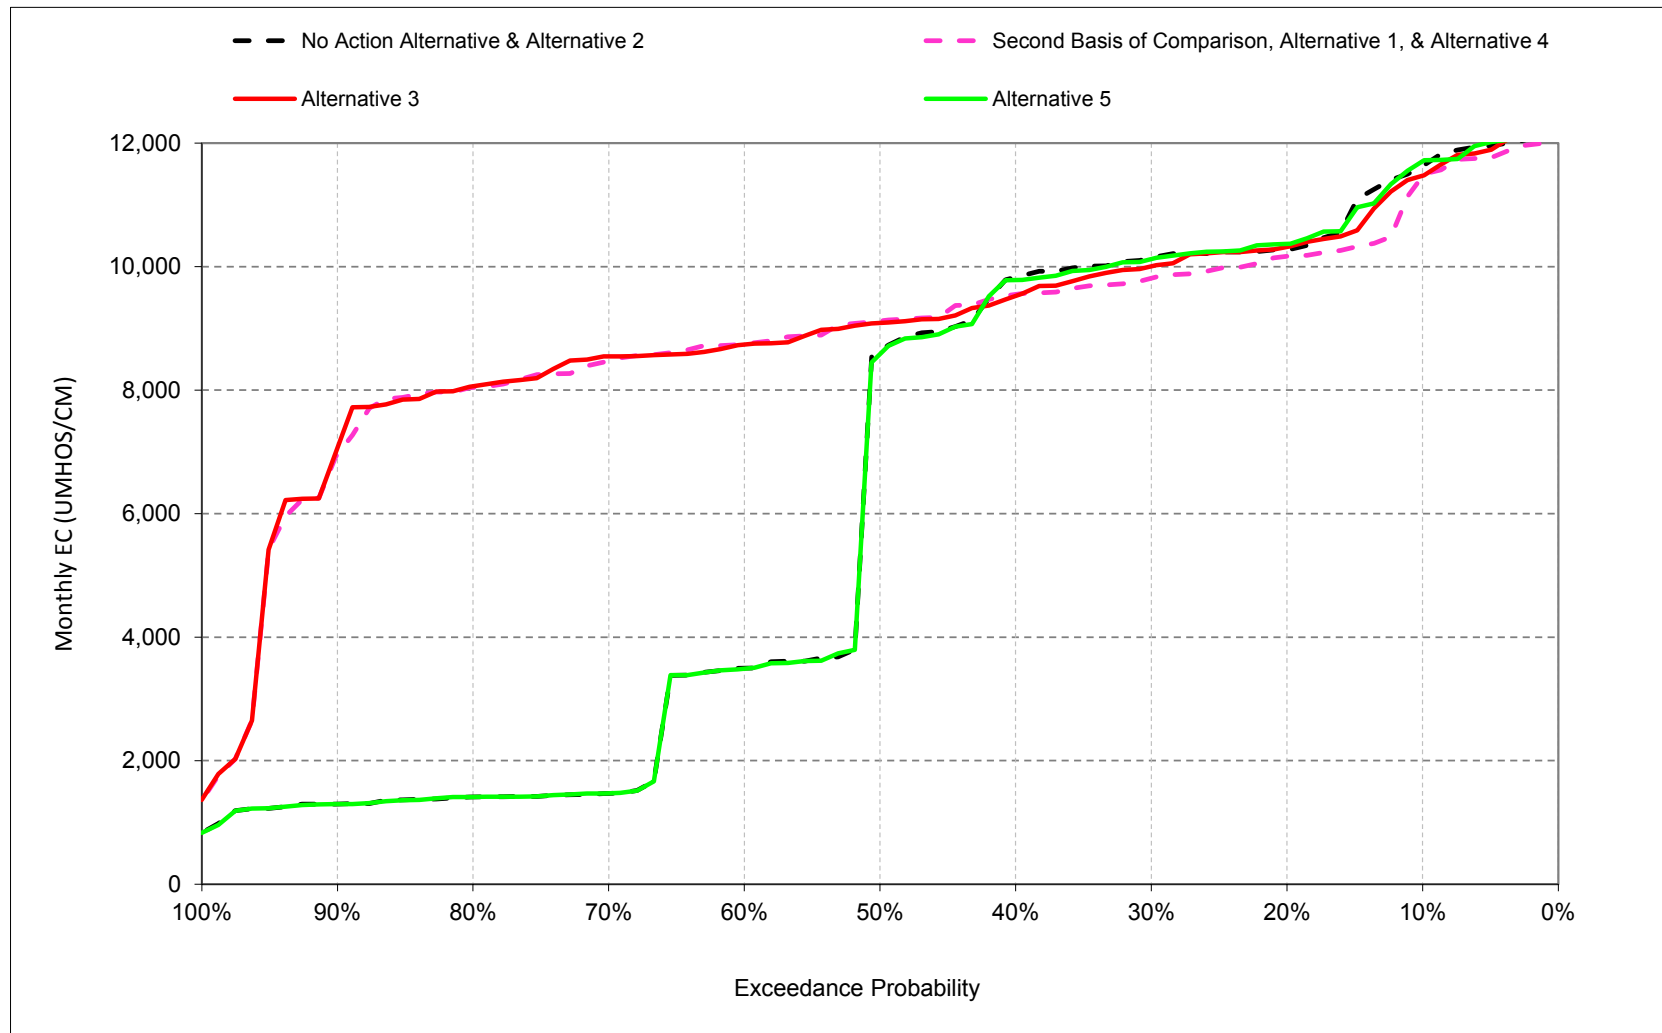


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.4.2. Sacramento River at Collinsville Salinity, Electrical Conductivity, November

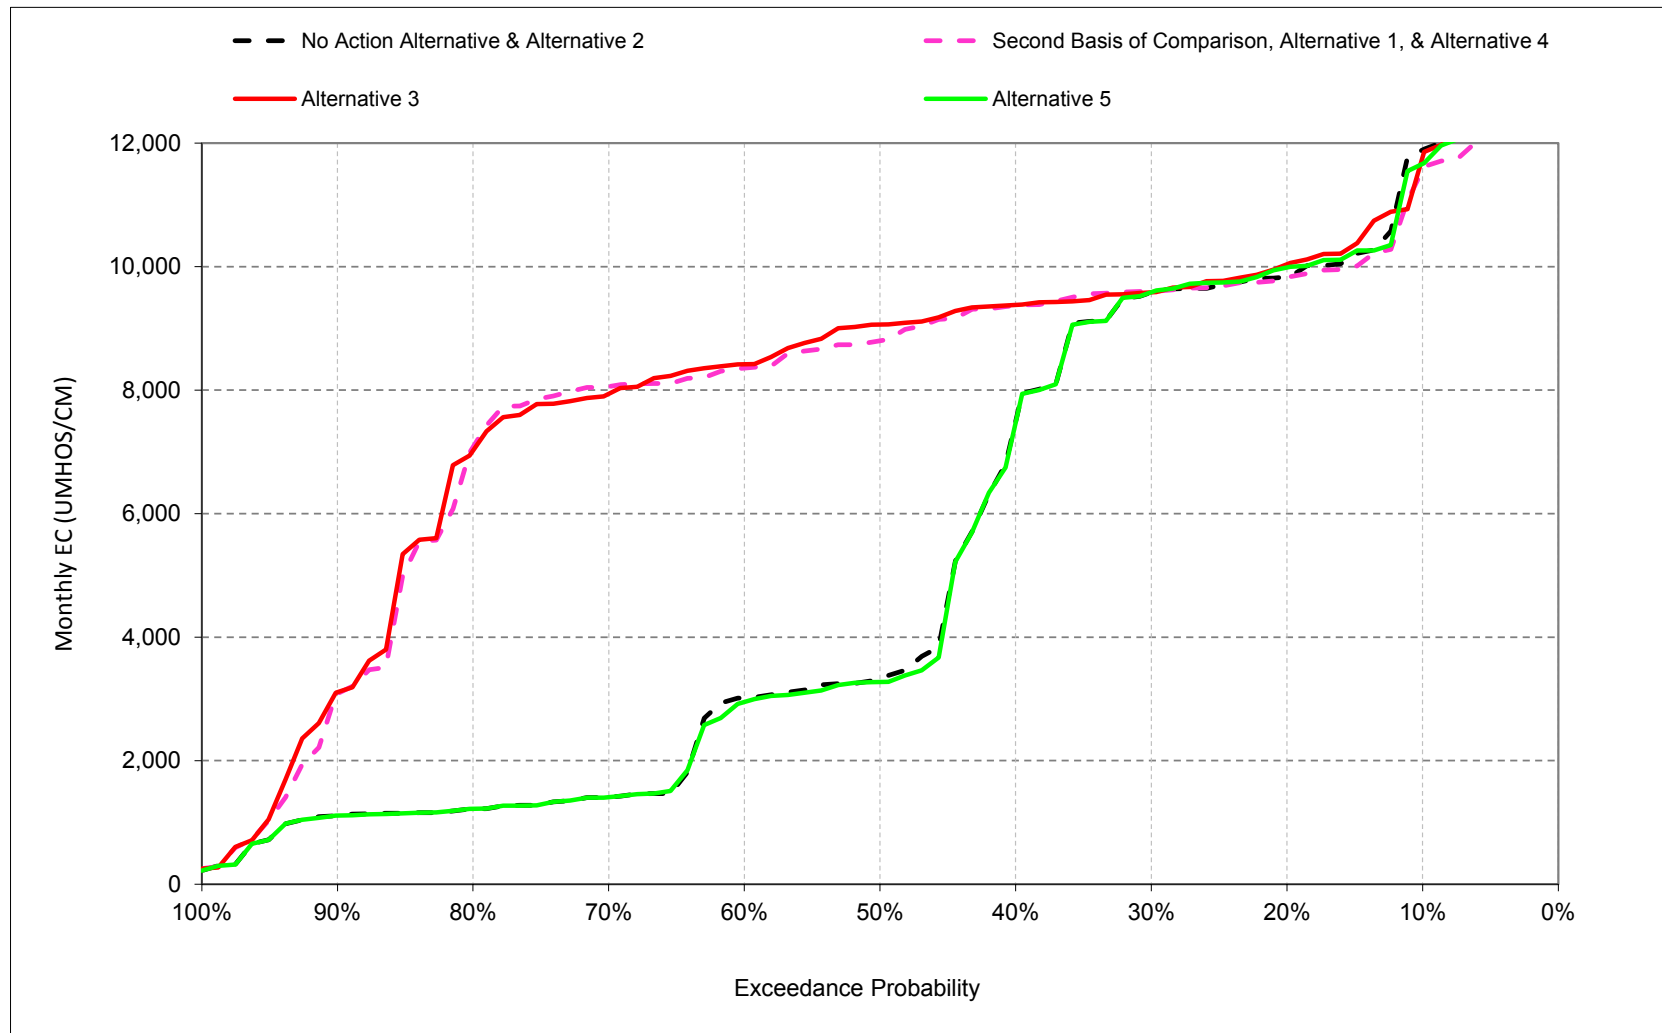


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.4.3. Sacramento River at Collinsville Salinity, Electrical Conductivity, December

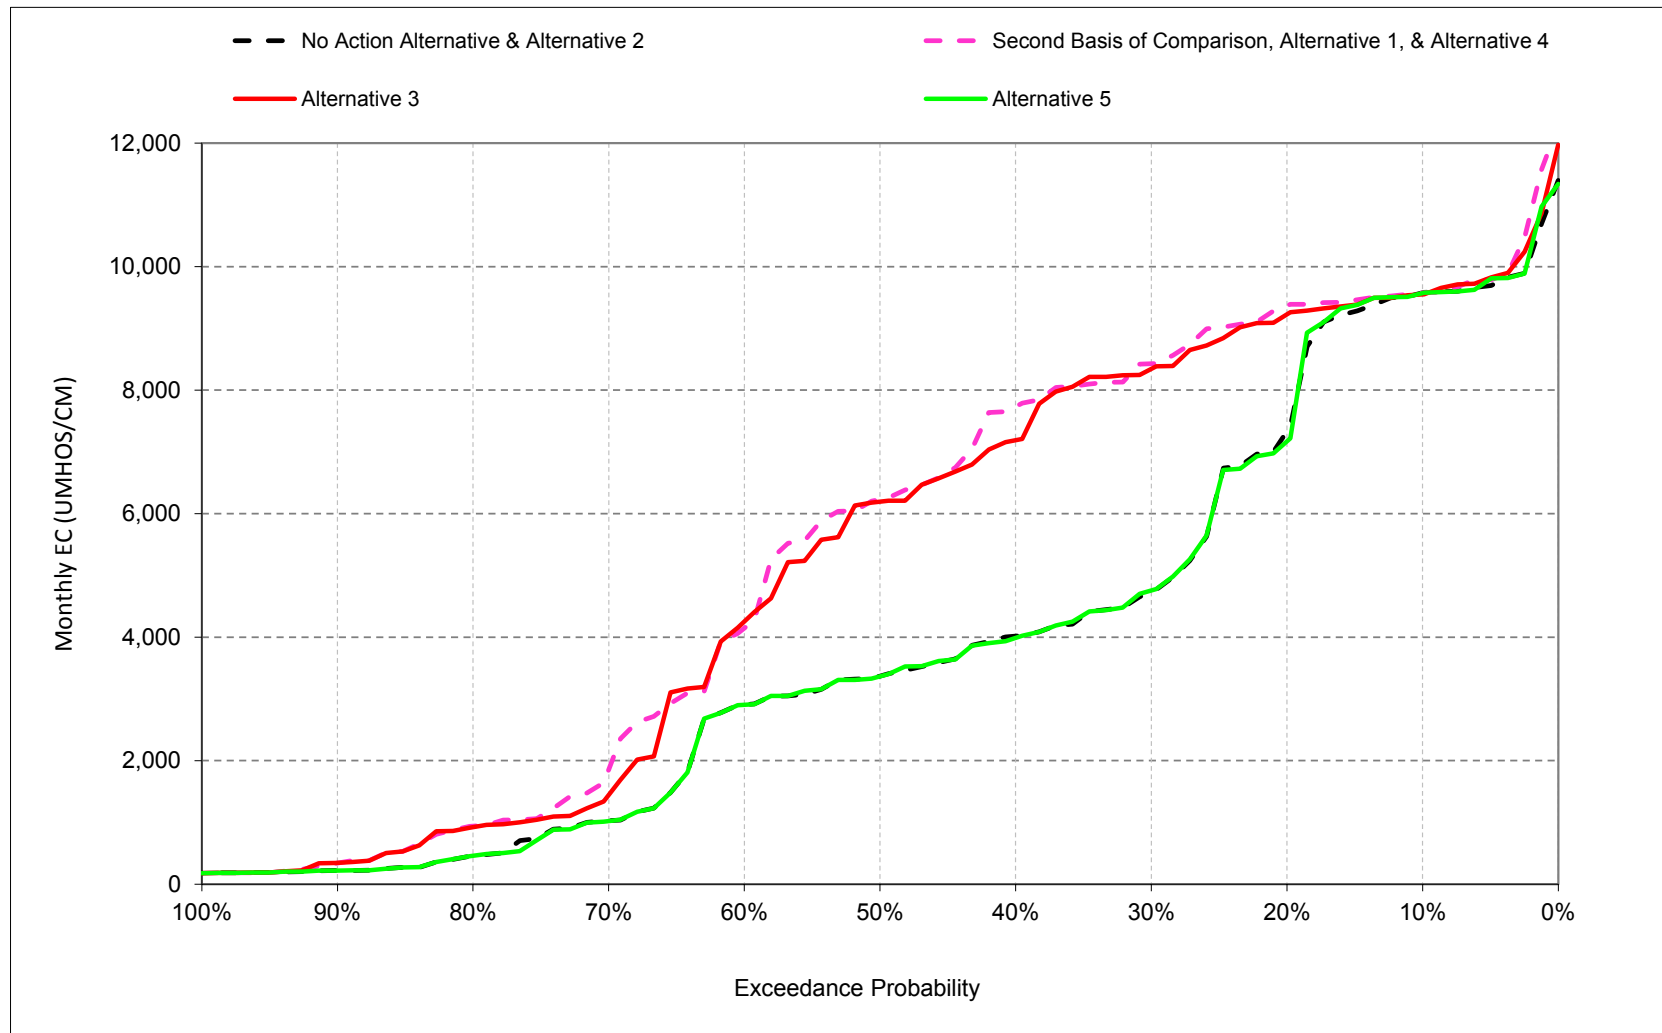


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.4.4. Sacramento River at Collinsville Salinity, Electrical Conductivity, January

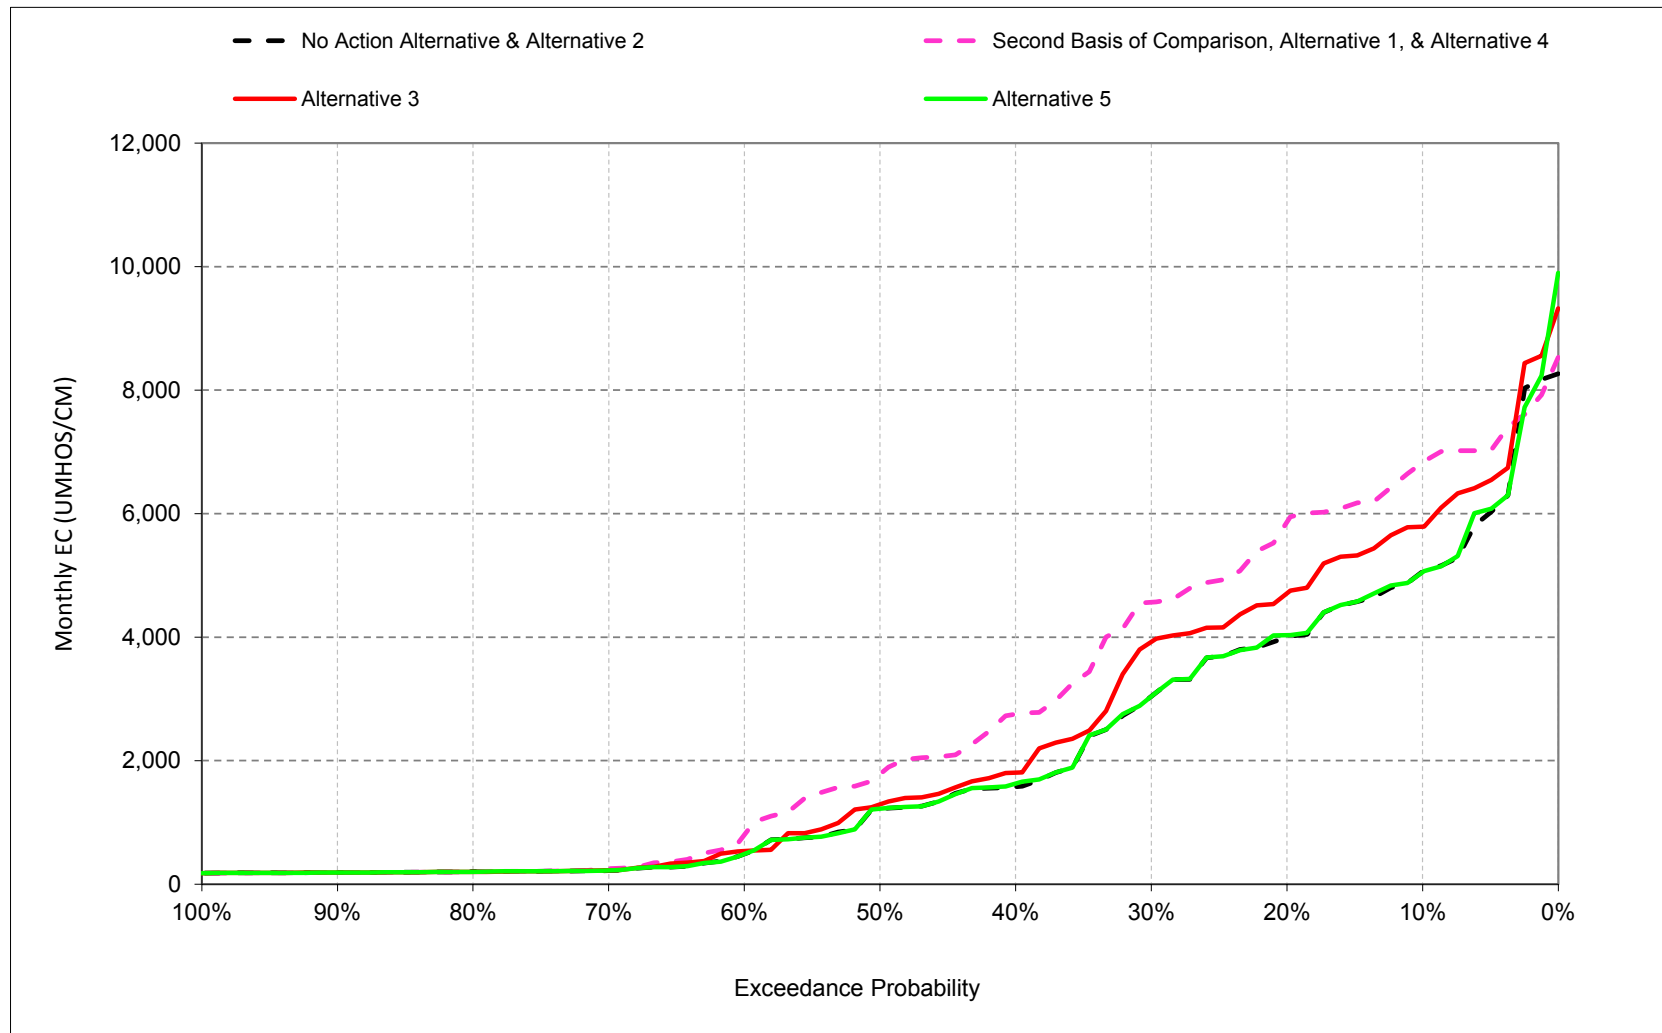


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.4.5. Sacramento River at Collinsville Salinity, Electrical Conductivity, February

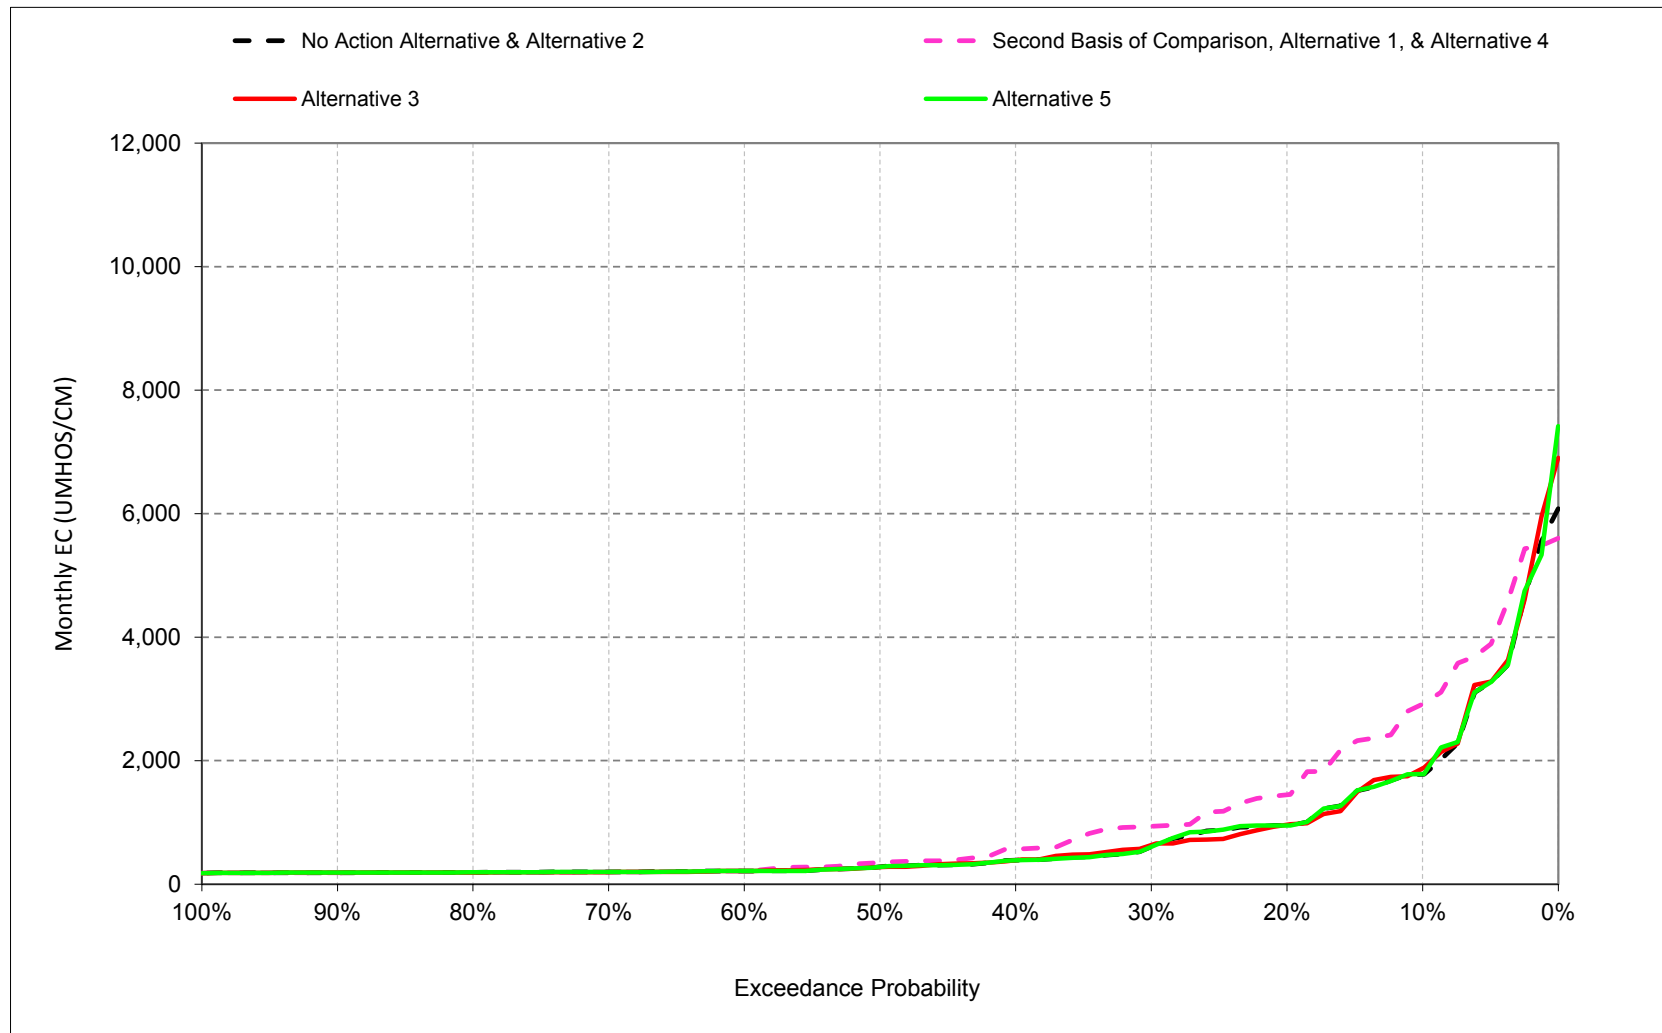


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.4.6. Sacramento River at Collinsville Salinity, Electrical Conductivity, March

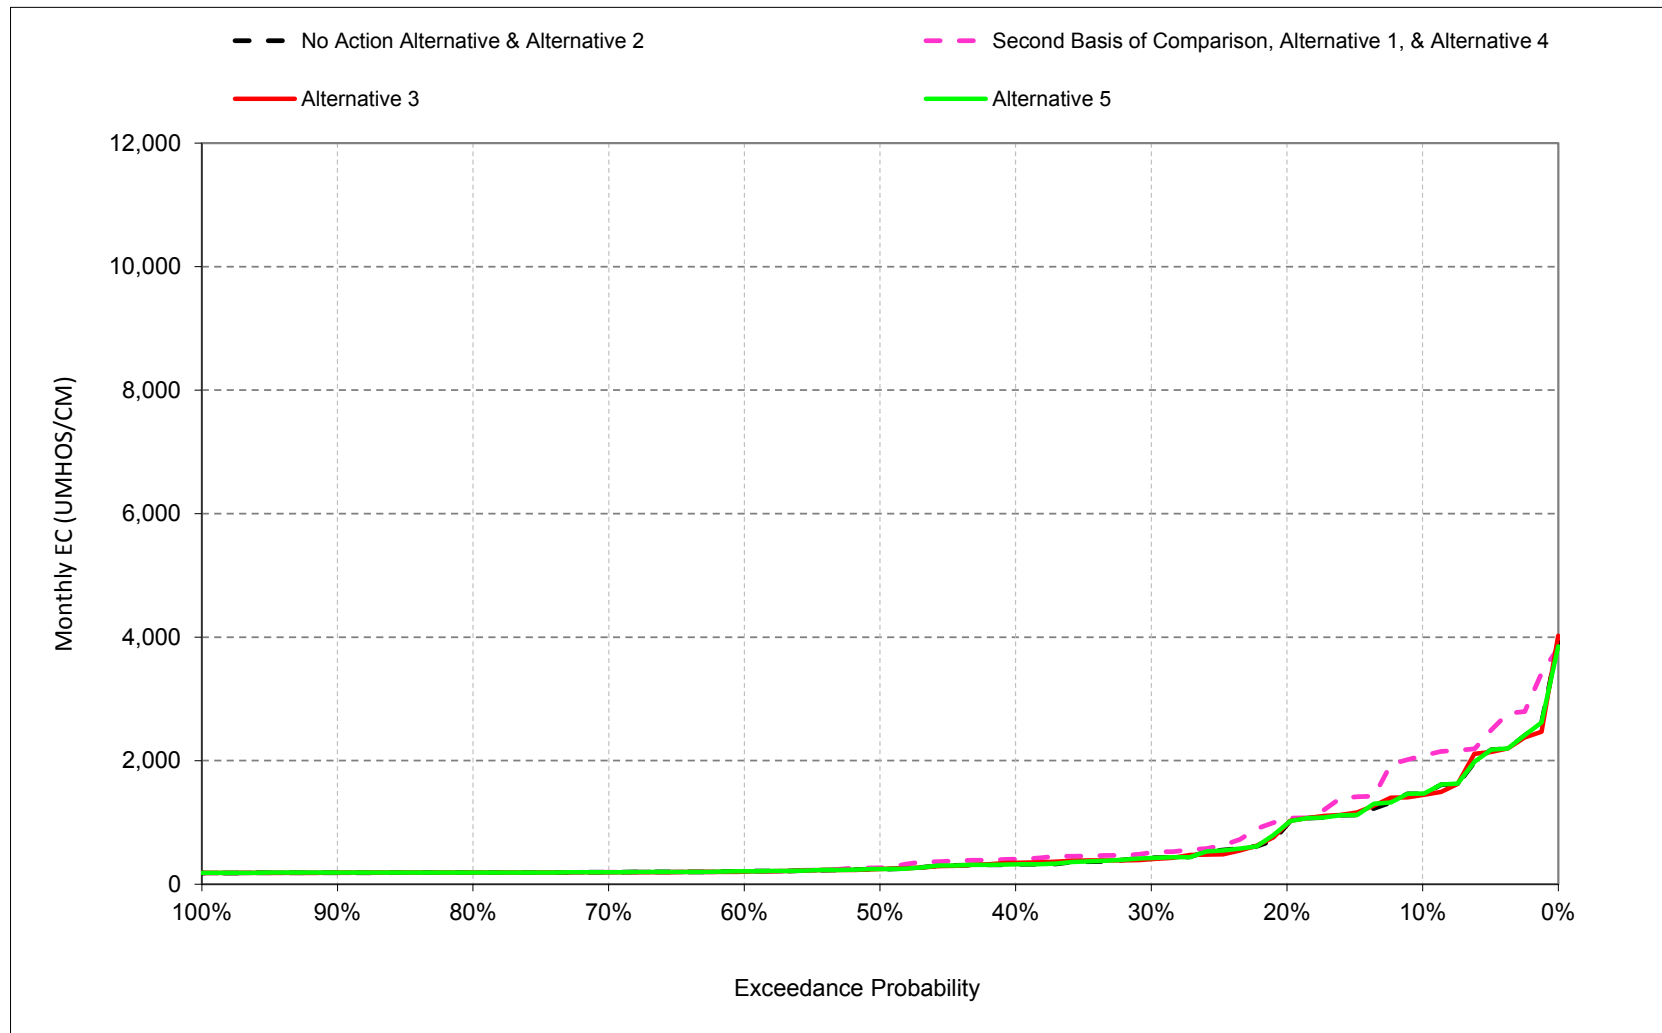


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.4.7. Sacramento River at Collinsville Salinity, Electrical Conductivity, April

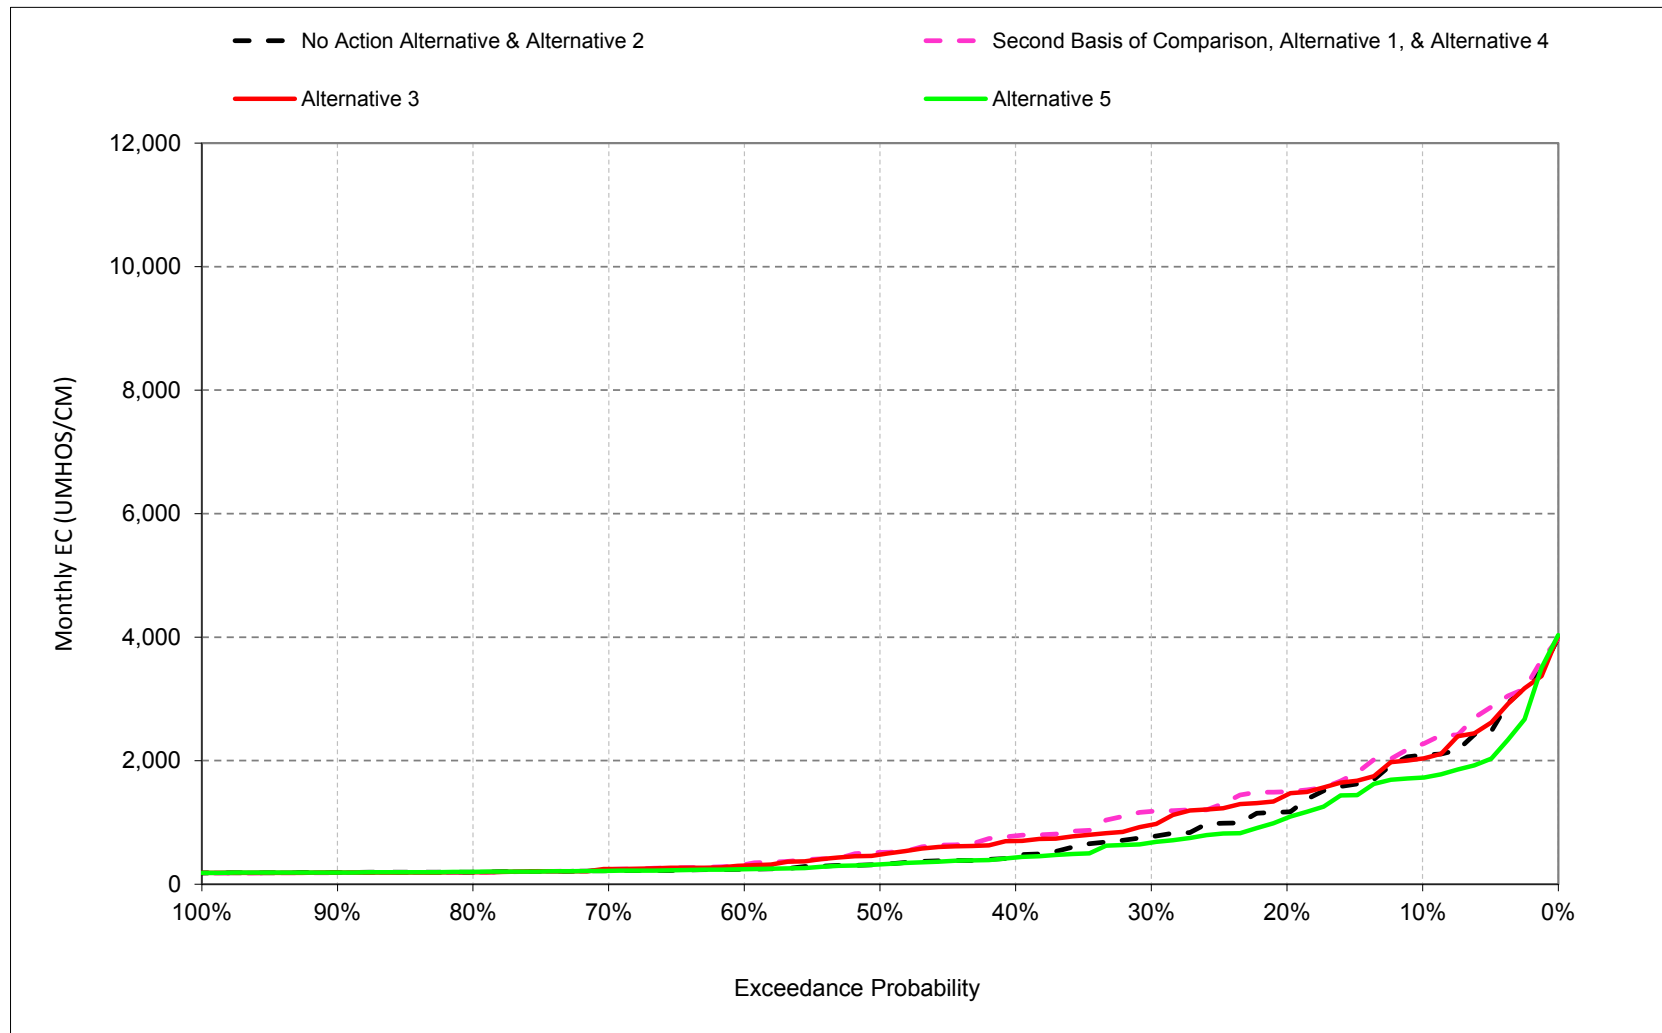


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.4.8. Sacramento River at Collinsville Salinity, Electrical Conductivity, May

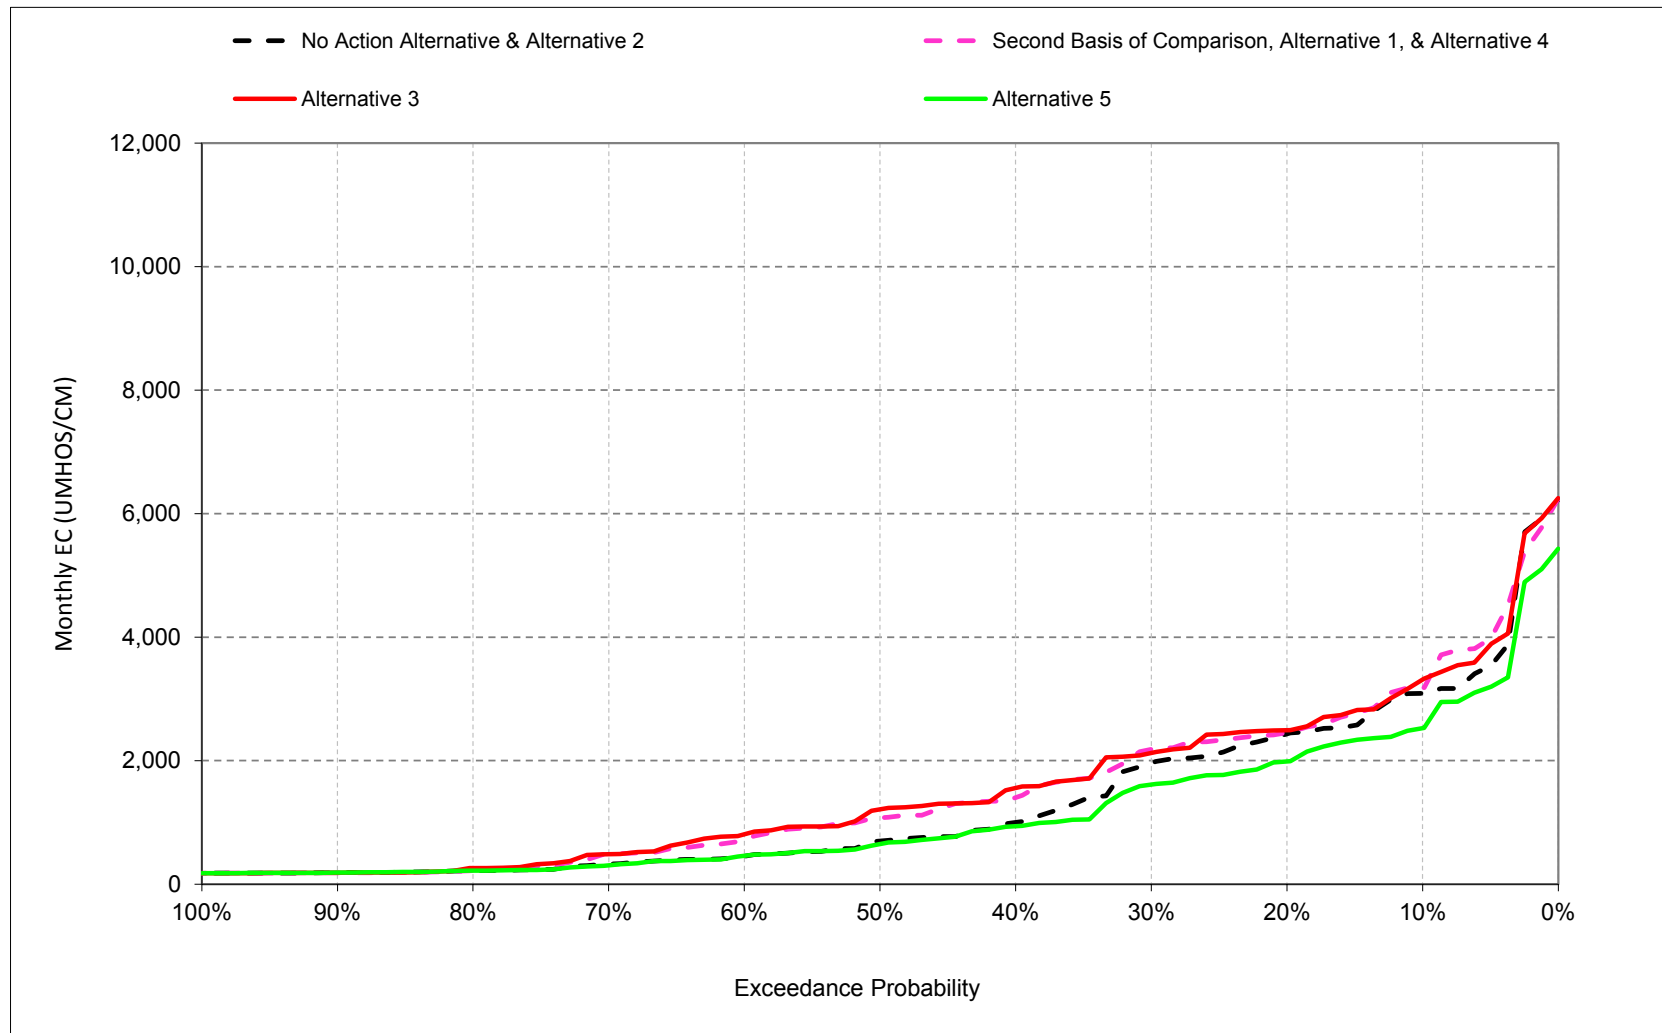


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.4.9. Sacramento River at Collinsville Salinity, Electrical Conductivity, June

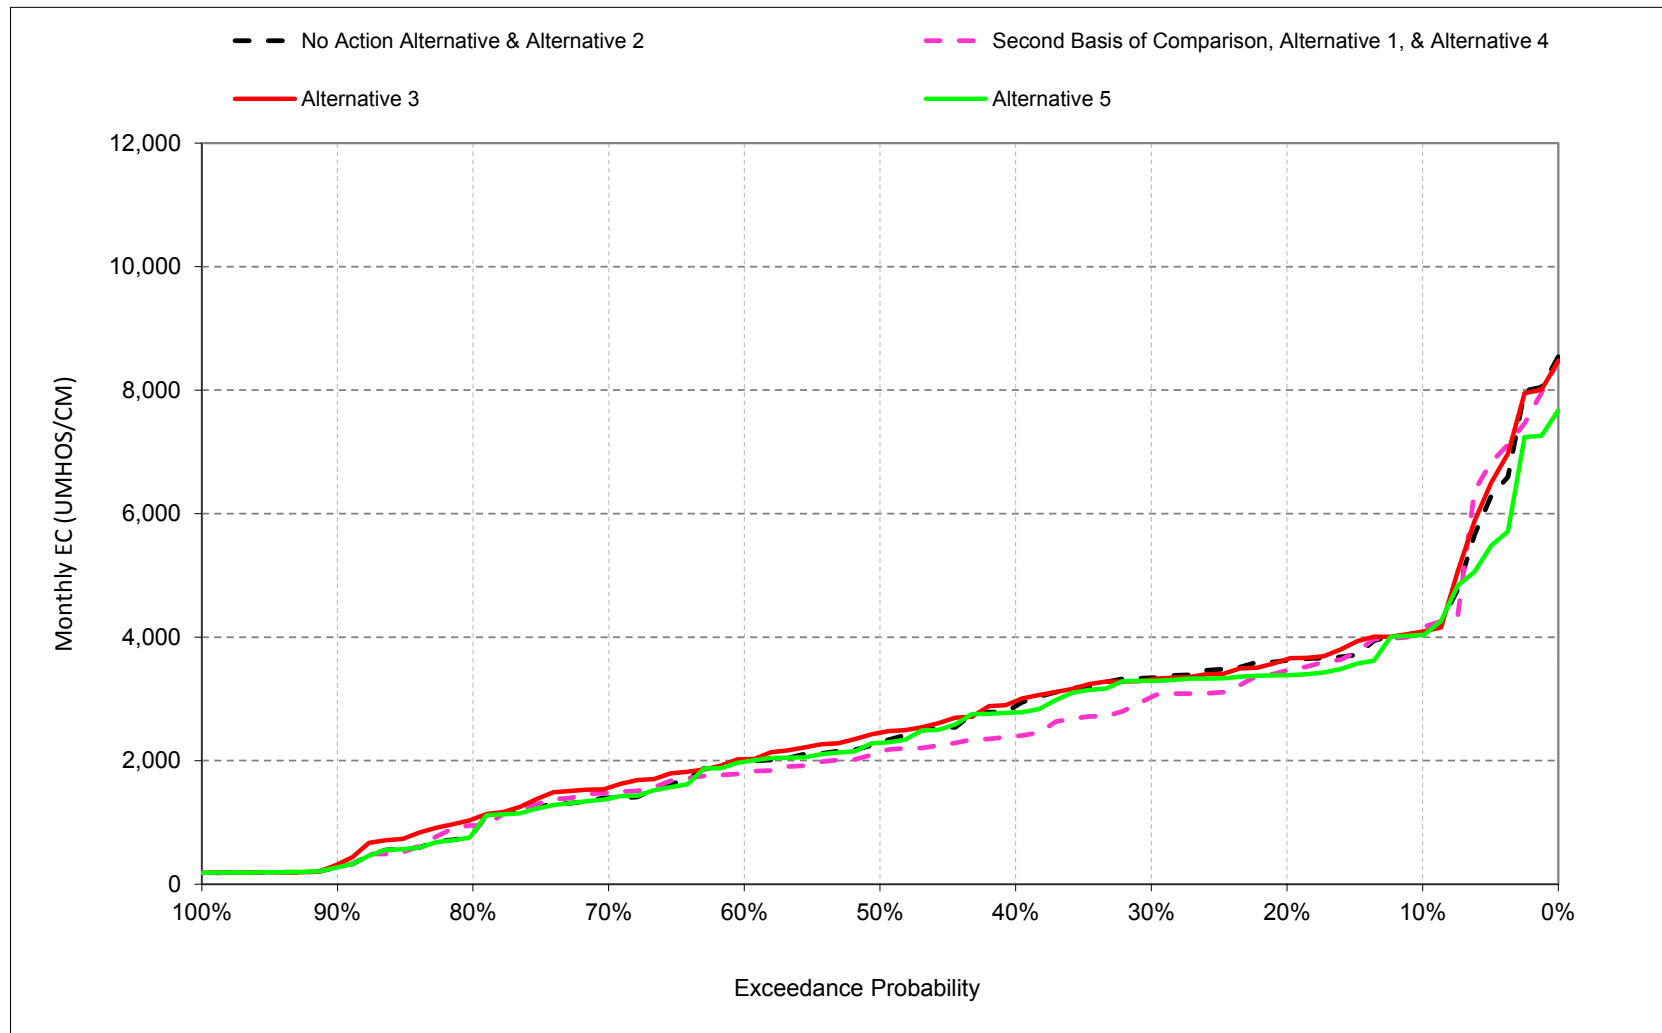


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.4.10. Sacramento River at Collinsville Salinity, Electrical Conductivity, July

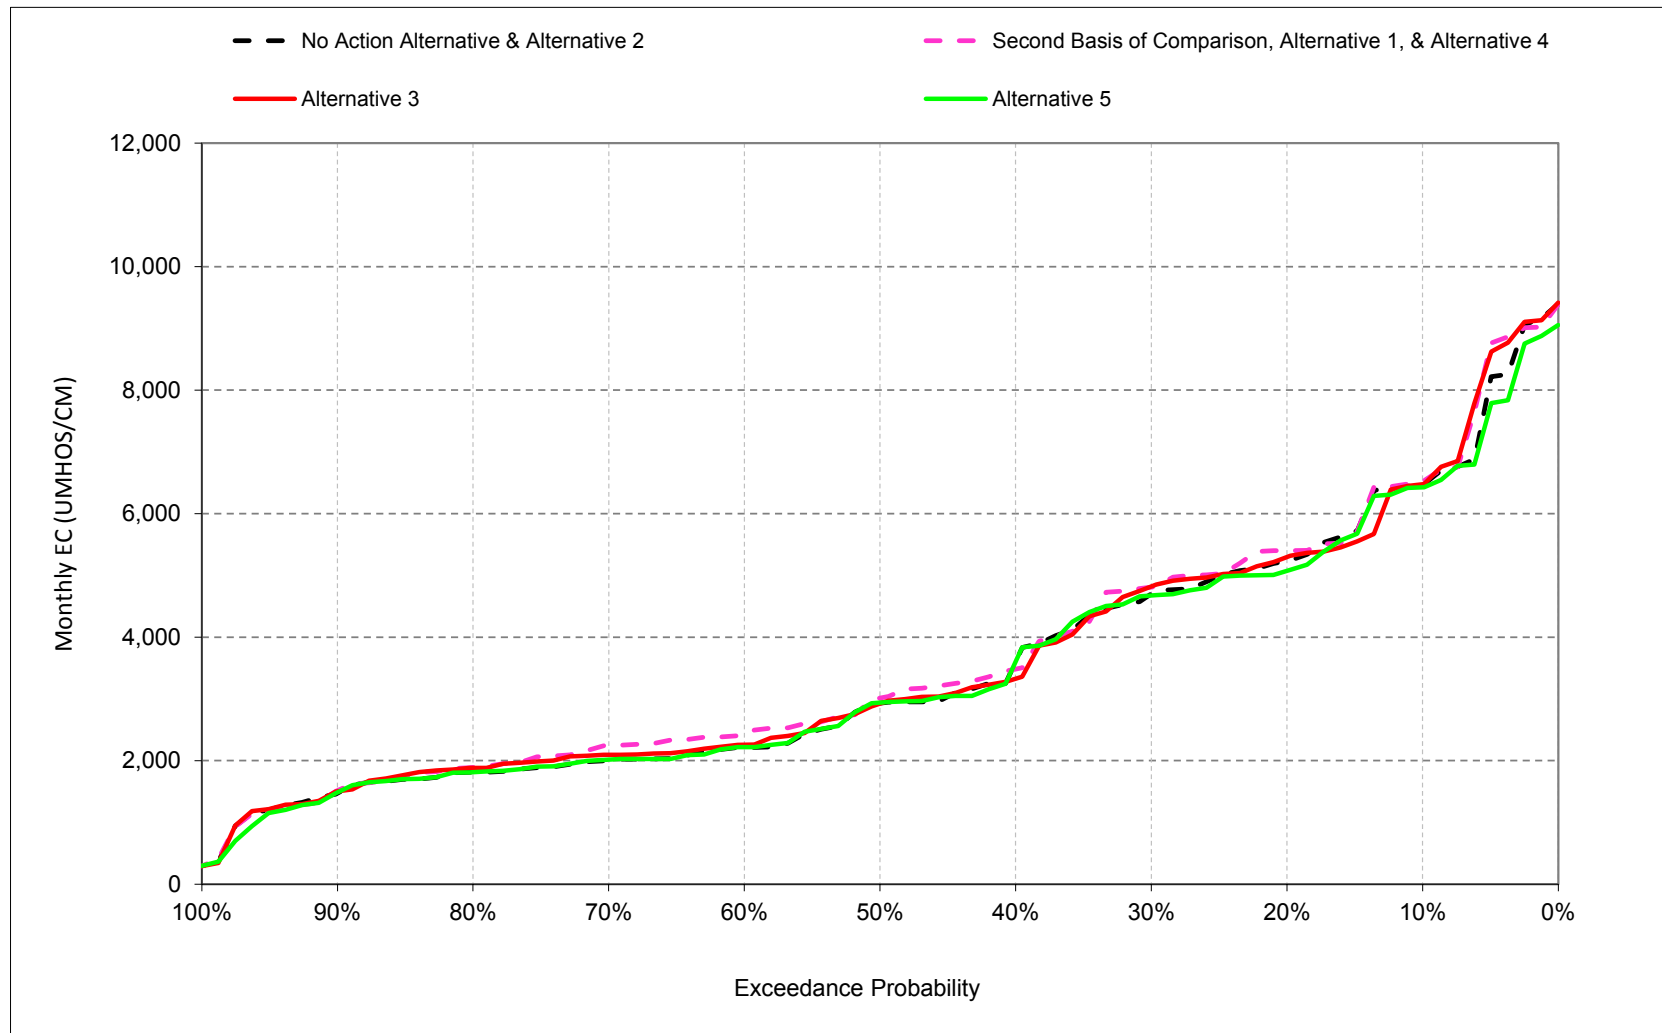


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.4.11. Sacramento River at Collinsville Salinity, Electrical Conductivity, August

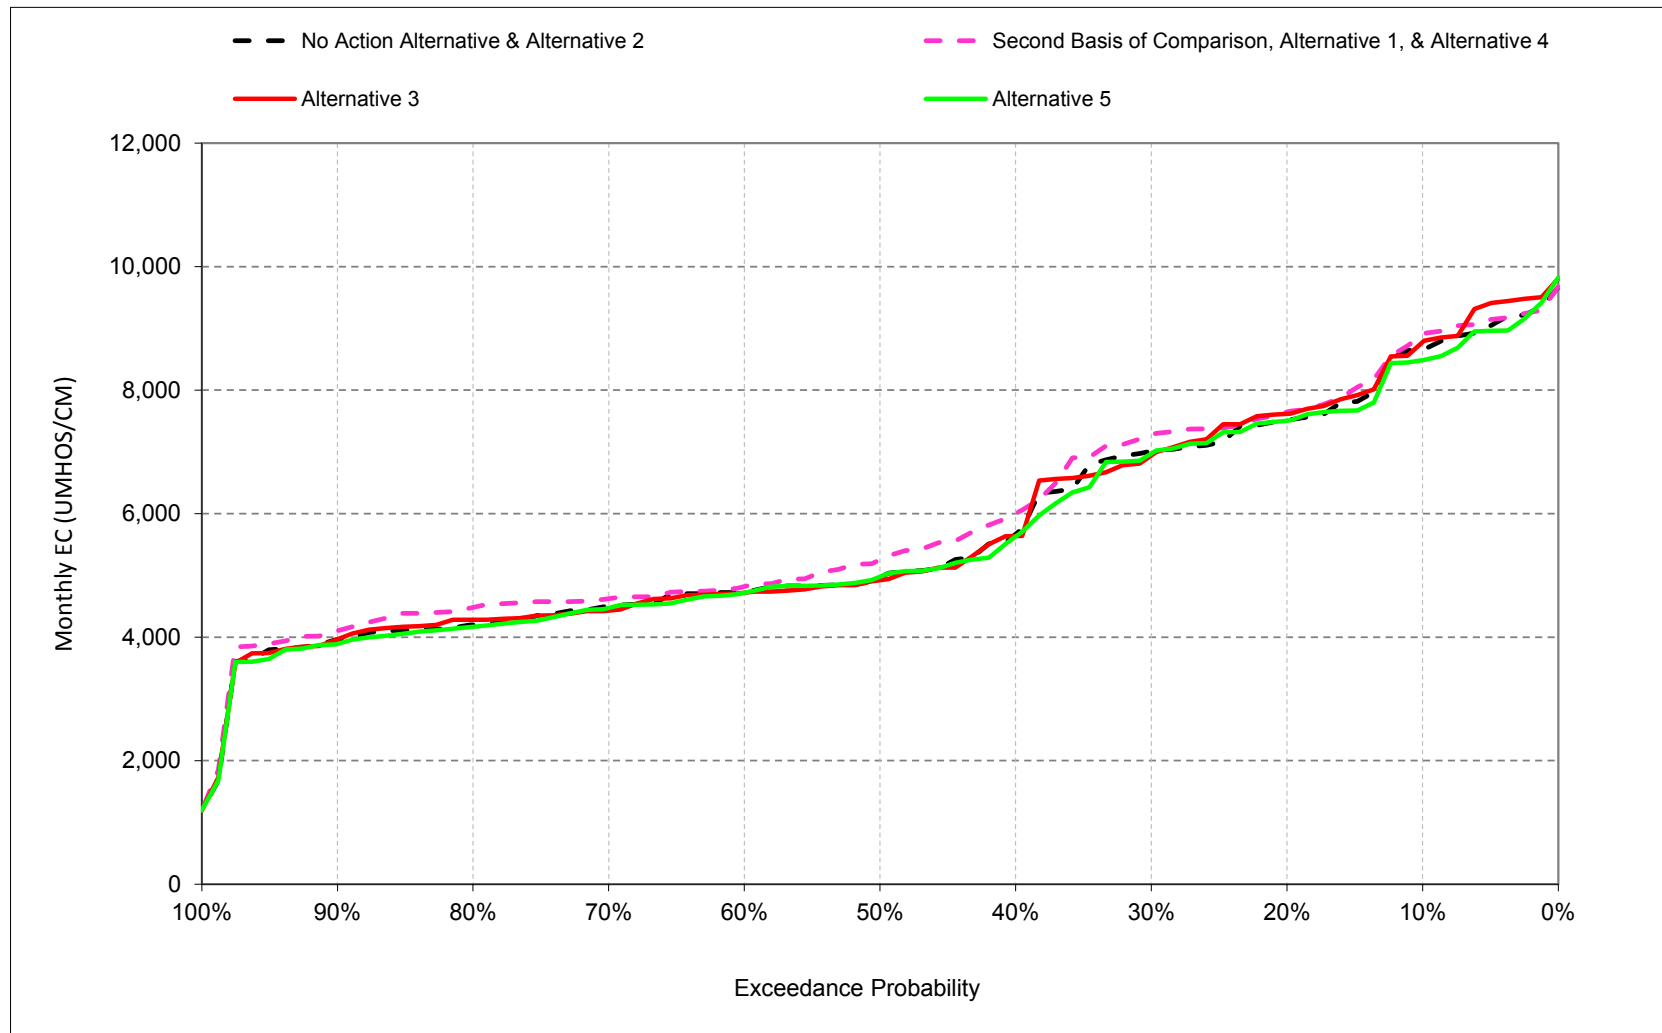

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.4.12. Sacramento River at Collinsville Salinity, Electrical Conductivity, September

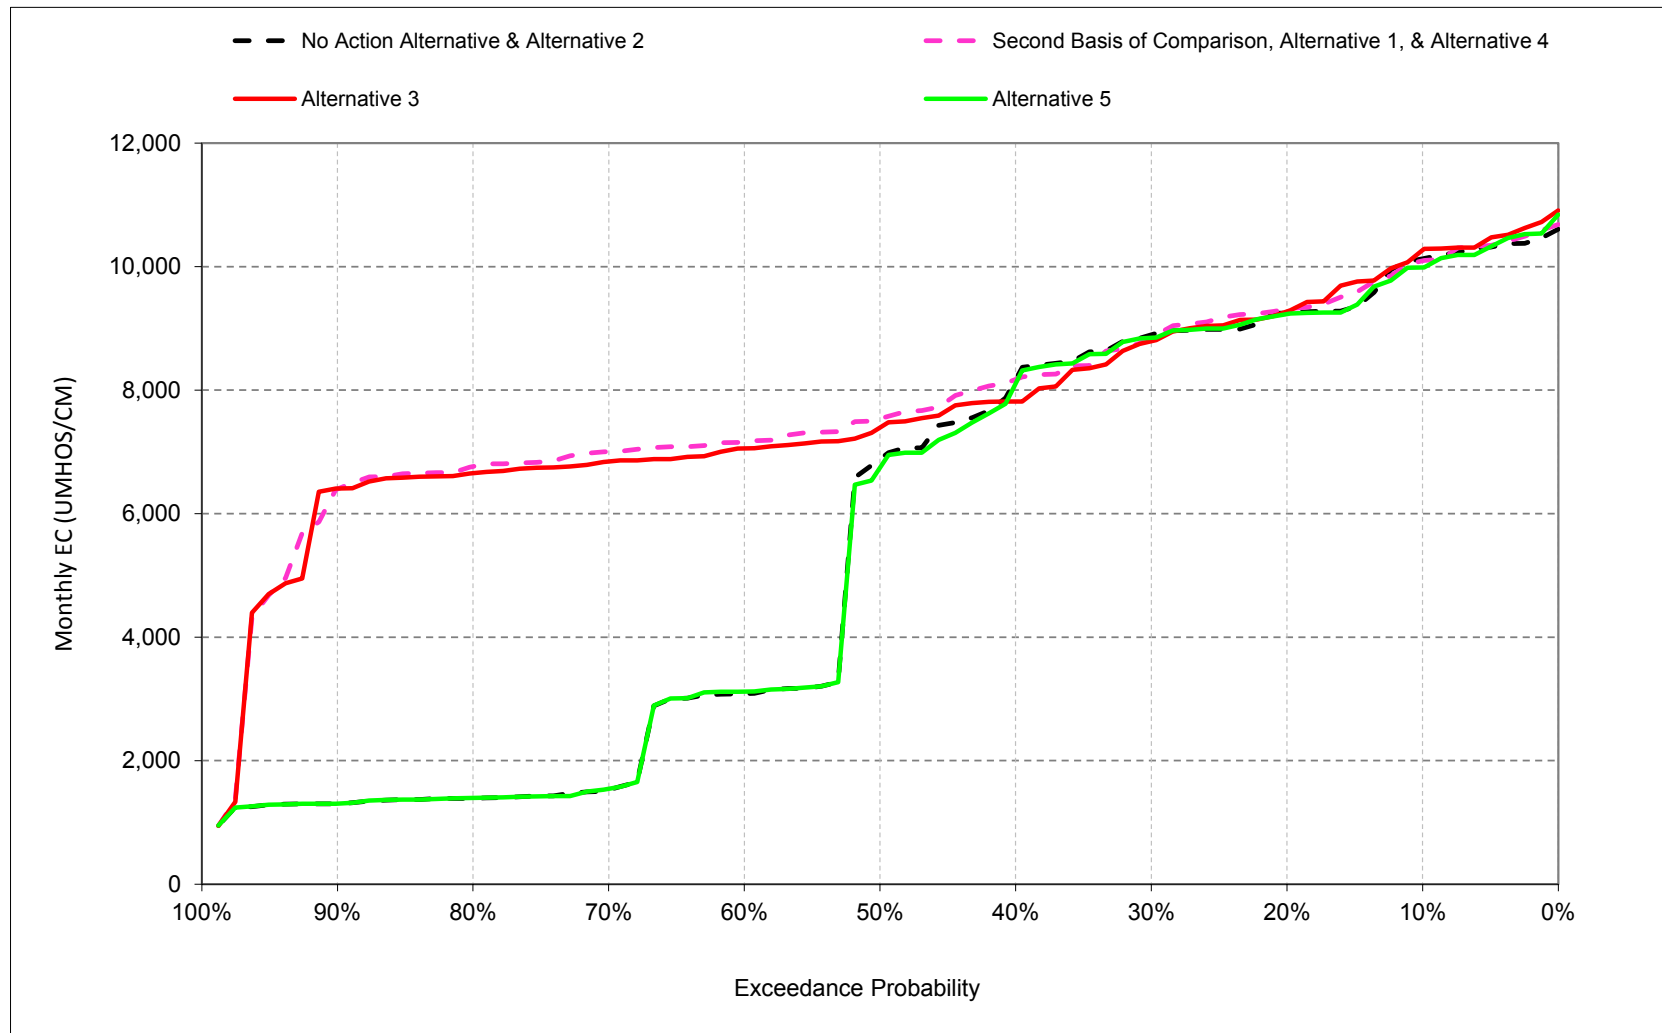

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.4.1. Sacramento River at Collinsville Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	11,632	11,890	9,578	5,063	1,781	1,464	2,090	3,090	4,155	6,476	8,660	10,127
20%	10,277	9,831	7,332	3,998	949	961	1,169	2,435	3,623	5,234	7,514	9,247
30%	10,141	9,585	4,732	3,041	606	426	769	1,962	3,340	4,700	7,013	8,896
40%	9,827	7,492	4,017	1,576	387	320	453	1,001	2,885	3,600	5,666	8,171
50%	8,639	3,336	3,369	1,222	281	244	322	698	2,293	2,932	4,968	6,885
60%	3,498	3,015	2,905	490	215	209	241	450	1,989	2,212	4,736	3,085
70%	1,470	1,410	1,029	222	198	193	218	326	1,397	2,004	4,502	1,602
80%	1,412	1,217	456	202	191	189	196	218	824	1,812	4,198	1,399
90%	1,298	1,110	222	188	186	187	190	188	272	1,471	3,961	1,323
Long Term												
Full Simulation Period ^b	6,320	5,459	3,962	2,015	786	573	761	1,307	2,527	3,544	5,733	5,585
Water Year Types^c												
Wet (32%)	4,370	3,158	1,166	437	202	202	225	319	1,019	1,619	4,183	1,371
Above Normal (16%)	7,918	5,626	3,329	851	275	229	264	484	1,882	2,111	4,271	3,089
Below Normal (13%)	4,510	4,152	4,004	2,297	836	671	811	1,339	2,771	3,082	5,111	7,668
Dry (24%)	6,869	6,488	5,652	3,088	1,075	599	870	1,632	3,030	4,941	7,136	8,778
Critical (15%)	9,556	9,748	7,846	4,647	2,075	1,615	2,228	3,767	5,434	7,359	8,905	10,190
Alternative 1												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	11,466	11,564	9,574	6,827	2,915	2,079	2,268	3,182	4,153	6,528	8,899	10,093
20%	10,165	9,824	9,367	5,863	1,446	1,055	1,498	2,452	3,462	5,402	7,644	9,312
30%	9,811	9,601	8,428	4,565	937	514	1,177	2,185	3,028	4,809	7,272	8,855
40%	9,549	9,369	7,734	2,753	570	406	783	1,403	2,397	3,484	6,003	8,173
50%	9,118	8,800	6,231	1,781	351	267	514	1,075	2,139	3,014	5,252	7,538
60%	8,747	8,357	4,144	797	217	206	316	723	1,804	2,442	4,820	7,164
70%	8,473	8,056	1,856	251	197	194	239	488	1,484	2,243	4,622	7,002
80%	8,043	7,074	940	202	189	189	195	222	949	1,891	4,481	6,761
90%	6,957	3,084	340	189	187	186	187	184	280	1,515	4,102	6,400
Long Term												
Full Simulation Period ^b	8,887	8,107	5,432	2,689	1,009	677	904	1,498	2,415	3,660	5,913	7,773
Water Year Types^c												
Wet (32%)	7,833	6,691	1,993	596	208	206	274	428	970	1,737	4,299	6,163
Above Normal (16%)	9,564	7,831	5,188	1,319	337	236	365	733	1,694	2,215	4,509	6,968
Below Normal (13%)	8,314	7,234	6,059	3,773	1,345	814	1,055	1,605	2,288	3,197	5,514	7,826
Dry (24%)	9,325	9,173	7,597	4,236	1,380	719	1,062	1,807	2,948	5,018	7,294	8,896
Critical (15%)	10,233	10,495	8,960	5,132	2,549	1,979	2,449	4,032	5,552	7,552	8,997	10,215
Alternative 1 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-166	-326	-4	1,764	1,134	615	178	92	-2	52	240	-34
20%	-112	-6	2,035	1,865	497	94	329	17	-161	168	130	65
30%	-330	16	3,696	1,524	332	89	409	223	-313	109	259	-41
40%	-278	1,877	3,717	1,177	183	85	330	402	-487	-117	336	3
50%	480	5,464	2,863	559	70	22	192	377	-154	82	284	653
60%	5,249	5,342	1,239	307	2	-3	74	273	-185	229	83	4,079
70%	7,003	6,646	827	29	-1	0	21	163	87	239	120	5,400
80%	6,631	5,857	484	-1	-2	0	-2	4	125	78	284	5,362
90%	5,658	1,974	118	0	1	0	-2	-4	8	44	142	5,077
Long Term												
Full Simulation Period ^b	2,567	2,648	1,470	674	224	104	143	191	-113	116	180	2,188
Water Year Types^c												
Wet (32%)	3,462	3,533	827	159	6	3	49	109	-49	118	116	4,792
Above Normal (16%)	1,646	2,206	1,859	469	61	7	101	248	-188	104	238	3,879
Below Normal (13%)	3,804	3,082	2,055	1,476	509	143	243	266	-482	115	403	157
Dry (24%)	2,456	2,685	1,945	1,148	305	120	192	175	-82	77	157	118
Critical (15%)	677	747	1,114	485	475	365	221	265	118	194	91	25

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.4.2. Sacramento River at Collinsville Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	11,632	11,890	9,578	5,063	1,781	1,464	2,090	3,090	4,155	6,476	8,660	10,127
20%	10,277	9,831	7,332	3,998	949	961	1,169	2,435	3,623	5,234	7,514	9,247
30%	10,141	9,585	4,732	3,041	606	426	769	1,962	3,340	4,700	7,013	8,896
40%	9,827	7,492	4,017	1,576	387	320	453	1,001	2,885	3,600	5,666	8,171
50%	8,639	3,336	3,369	1,222	281	244	322	698	2,293	2,932	4,968	6,885
60%	3,498	3,015	2,905	490	215	209	241	450	1,989	2,212	4,736	3,085
70%	1,470	1,410	1,029	222	198	193	218	326	1,397	2,004	4,502	1,602
80%	1,412	1,217	456	202	191	189	196	218	824	1,812	4,198	1,399
90%	1,298	1,110	222	188	186	187	190	188	272	1,471	3,961	1,323
Long Term												
Full Simulation Period ^b	6,320	5,459	3,962	2,015	786	573	761	1,307	2,527	3,544	5,733	5,585
Water Year Types ^c												
Wet (32%)	4,370	3,158	1,166	437	202	202	225	319	1,019	1,619	4,183	1,371
Above Normal (16%)	7,918	5,626	3,329	851	275	229	264	484	1,882	2,111	4,271	3,089
Below Normal (13%)	4,510	4,152	4,004	2,297	836	671	811	1,339	2,771	3,082	5,111	7,668
Dry (24%)	6,869	6,488	5,652	3,088	1,075	599	870	1,632	3,030	4,941	7,136	8,778
Critical (15%)	9,556	9,748	7,846	4,647	2,075	1,615	2,228	3,767	5,434	7,359	8,905	10,190
Alternative 3												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	11,473	11,766	9,549	5,787	1,874	1,443	2,034	3,312	4,091	6,476	8,774	10,265
20%	10,316	10,036	9,229	4,708	962	974	1,448	2,492	3,643	5,299	7,615	9,272
30%	10,004	9,582	8,343	3,924	635	404	960	2,126	3,317	4,823	6,941	8,790
40%	9,525	9,380	7,191	1,805	387	347	700	1,558	2,966	3,326	5,638	7,814
50%	9,090	9,062	6,196	1,292	276	246	478	1,211	2,453	2,926	4,922	7,392
60%	8,738	8,417	4,254	537	212	203	300	808	2,026	2,259	4,719	7,055
70%	8,546	7,940	1,444	225	196	194	245	483	1,562	2,095	4,431	6,842
80%	8,062	7,019	924	200	190	189	195	260	1,055	1,881	4,283	6,655
90%	7,063	3,108	346	189	187	186	187	184	321	1,503	3,965	6,417
Long Term												
Full Simulation Period ^b	8,974	8,210	5,317	2,300	801	573	848	1,520	2,604	3,586	5,768	7,701
Water Year Types ^c												
Wet (32%)	7,796	6,755	1,924	491	202	207	273	471	1,124	1,679	4,162	6,134
Above Normal (16%)	9,825	7,890	4,901	1,000	262	224	349	768	1,940	2,155	4,365	6,907
Below Normal (13%)	8,504	7,415	6,070	2,839	866	676	979	1,668	2,876	3,070	5,050	7,399
Dry (24%)	9,320	9,273	7,532	3,550	1,062	596	973	1,844	3,079	4,904	7,199	8,884
Critical (15%)	10,461	10,663	8,736	5,052	2,188	1,613	2,307	3,932	5,486	7,543	9,042	10,260
Alternative 3 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-159	-124	-29	724	92	-21	-56	222	-64	0	114	138
20%	40	206	1,897	710	13	13	279	57	20	66	102	25
30%	-137	-3	3,611	882	29	-22	192	164	-23	123	-72	-106
40%	-303	1,888	3,174	229	0	27	247	557	81	-274	-28	-357
50%	451	5,726	2,827	70	-5	2	156	514	160	-5	-45	507
60%	5,241	5,402	1,349	47	-2	-5	59	358	37	47	-17	3,971
70%	7,076	6,530	416	3	-2	0	27	157	165	90	-71	5,240
80%	6,650	5,801	467	-3	-2	0	-1	42	231	69	86	5,256
90%	5,765	1,999	124	0	1	-1	-2	-4	49	31	5	5,094
Long Term												
Full Simulation Period ^b	2,654	2,751	1,355	285	15	1	88	213	76	42	35	2,115
Water Year Types ^c												
Wet (32%)	3,425	3,597	757	54	-1	5	48	152	105	59	-21	4,763
Above Normal (16%)	1,907	2,265	1,572	149	-14	-4	85	284	58	44	93	3,818
Below Normal (13%)	3,994	3,264	2,066	543	30	5	167	329	105	-13	-61	-270
Dry (24%)	2,451	2,786	1,880	462	-13	-3	102	211	49	-37	63	106
Critical (15%)	904	915	890	405	114	-2	80	165	53	184	137	71

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.4.3. Sacramento River at Collinsville Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	11,632	11,890	9,578	5,063	1,781	1,464	2,090	3,090	4,155	6,476	8,660	10,127
20%	10,277	9,831	7,332	3,998	949	961	1,169	2,435	3,623	5,234	7,514	9,247
30%	10,141	9,585	4,732	3,041	606	426	769	1,962	3,340	4,700	7,013	8,896
40%	9,827	7,492	4,017	1,576	387	320	453	1,001	2,885	3,600	5,666	8,171
50%	8,639	3,336	3,369	1,222	281	244	322	698	2,293	2,932	4,968	6,885
60%	3,498	3,015	2,905	490	215	209	241	450	1,989	2,212	4,736	3,085
70%	1,470	1,410	1,029	222	198	193	218	326	1,397	2,004	4,502	1,602
80%	1,412	1,217	456	202	191	189	196	218	824	1,812	4,198	1,399
90%	1,298	1,110	222	188	186	187	190	188	272	1,471	3,961	1,323
Long Term												
Full Simulation Period ^b	6,320	5,459	3,962	2,015	786	573	761	1,307	2,527	3,544	5,733	5,585
Water Year Types^c												
Wet (32%)	4,370	3,158	1,166	437	202	202	225	319	1,019	1,619	4,183	1,371
Above Normal (16%)	7,918	5,626	3,329	851	275	229	264	484	1,882	2,111	4,271	3,089
Below Normal (13%)	4,510	4,152	4,004	2,297	836	671	811	1,339	2,771	3,082	5,111	7,668
Dry (24%)	6,869	6,488	5,652	3,088	1,075	599	870	1,632	3,030	4,941	7,136	8,778
Critical (15%)	9,556	9,748	7,846	4,647	2,075	1,615	2,228	3,767	5,434	7,359	8,905	10,190

Alternative 5												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	11,705	11,663	9,569	5,052	1,782	1,468	1,727	2,525	4,035	6,427	8,485	9,986
20%	10,368	9,986	7,171	4,034	950	978	1,075	1,987	3,386	5,074	7,505	9,231
30%	10,121	9,585	4,758	3,042	605	424	675	1,614	3,293	4,676	6,975	8,848
40%	9,781	7,463	3,988	1,630	387	319	431	939	2,780	3,601	5,629	8,104
50%	8,583	3,273	3,366	1,222	281	246	321	651	2,291	2,939	4,979	6,741
60%	3,488	2,950	2,905	488	215	208	242	459	1,984	2,219	4,721	3,119
70%	1,470	1,410	1,021	222	198	193	218	303	1,388	2,016	4,472	1,600
80%	1,413	1,219	460	202	191	189	198	218	825	1,814	4,170	1,404
90%	1,295	1,110	222	188	186	187	190	188	273	1,488	3,890	1,324
Long Term												
Full Simulation Period ^b	6,311	5,440	3,967	2,039	804	574	682	1,148	2,424	3,494	5,684	5,571
Water Year Types^c												
Wet (32%)	4,367	3,175	1,168	437	202	202	224	306	1,015	1,598	4,138	1,371
Above Normal (16%)	7,893	5,516	3,295	850	275	229	264	474	1,874	2,111	4,272	3,103
Below Normal (13%)	4,522	4,157	4,009	2,301	835	670	725	1,189	2,726	3,065	5,071	7,586
Dry (24%)	6,861	6,468	5,682	3,112	1,081	600	739	1,414	2,917	4,887	7,081	8,770
Critical (15%)	9,529	9,725	7,860	4,772	2,188	1,625	1,993	3,221	4,976	7,175	8,795	10,167

Alternative 5 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	74	-227	-9	-11	0	4	-363	-565	-119	-49	-175	-141
20%	92	156	-161	35	0	17	-94	-448	-237	-160	-9	-17
30%	-20	0	26	0	-1	-2	-94	-348	-47	-25	-38	-48
40%	-46	-29	-28	54	0	-1	-23	-62	-105	1	-37	-67
50%	-56	-63	-3	0	0	2	-1	-47	-2	7	11	-143
60%	-10	-66	0	-1	0	-1	1	9	-5	7	-16	34
70%	0	0	-7	0	0	0	0	-22	-9	11	-30	-3
80%	0	2	4	0	0	0	2	-1	1	2	-28	5
90%	-3	0	0	0	0	0	0	0	0	16	-71	1
Long Term												
Full Simulation Period ^b	-9	-19	5	25	18	2	-78	-159	-103	-49	-49	-14
Water Year Types^c												
Wet (32%)	-3	17	2	0	0	0	-1	-13	-4	-21	-45	0
Above Normal (16%)	-25	-109	-34	-1	0	0	0	-11	-8	0	1	14
Below Normal (13%)	12	6	6	5	-1	-1	-86	-150	-45	-17	-40	-83
Dry (24%)	-7	-19	29	24	6	1	-132	-218	-113	-54	-56	-8
Critical (15%)	-28	-23	13	125	114	10	-235	-546	-457	-184	-110	-22

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.4.4. Sacramento River at Collinsville Salinity, Monthly EC

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	11,466	11,564	9,574	6,827	2,915	2,079	2,268	3,182	4,153	6,528	8,899	10,093
20%	10,165	9,824	9,367	5,863	1,446	1,055	1,498	2,452	3,462	5,402	7,644	9,312
30%	9,811	9,601	8,428	4,565	937	514	1,177	2,185	3,028	4,809	7,272	8,855
40%	9,549	9,369	7,734	2,753	570	406	783	1,403	2,397	3,484	6,003	8,173
50%	9,118	8,800	6,231	1,781	351	267	514	1,075	2,139	3,014	5,252	7,538
60%	8,747	8,357	4,144	797	217	206	316	723	1,804	2,442	4,820	7,164
70%	8,473	8,056	1,856	251	197	194	239	488	1,484	2,243	4,622	7,002
80%	8,043	7,074	940	202	189	189	195	222	949	1,891	4,481	6,761
90%	6,957	3,084	340	189	187	186	187	184	280	1,515	4,102	6,400
Long Term												
Full Simulation Period ^b	8,887	8,107	5,432	2,689	1,009	677	904	1,498	2,415	3,660	5,913	7,773
Water Year Types ^c												
Wet (32%)	7,833	6,691	1,993	596	208	206	274	428	970	1,737	4,299	6,163
Above Normal (16%)	9,564	7,831	5,188	1,319	337	236	365	733	1,694	2,215	4,509	6,968
Below Normal (13%)	8,314	7,234	6,059	3,773	1,345	814	1,055	1,605	2,288	3,197	5,514	7,826
Dry (24%)	9,325	9,173	7,597	4,236	1,380	719	1,062	1,807	2,948	5,018	7,294	8,896
Critical (15%)	10,233	10,495	8,960	5,132	2,549	1,979	2,449	4,032	5,552	7,552	8,997	10,215

No Action Alternative

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	11,632	11,890	9,578	5,063	1,781	1,464	2,090	3,090	4,155	6,476	8,660	10,127
20%	10,277	9,831	7,332	3,998	949	961	1,169	2,435	3,623	5,234	7,514	9,247
30%	10,141	9,585	4,732	3,041	606	426	769	1,962	3,340	4,700	7,013	8,896
40%	9,827	7,492	4,017	1,576	387	320	453	1,001	2,885	3,600	5,666	8,171
50%	8,639	3,336	3,369	1,222	281	244	322	698	2,293	2,932	4,968	6,885
60%	3,498	3,015	2,905	490	215	209	241	450	1,989	2,212	4,736	3,085
70%	1,470	1,410	1,029	222	198	193	218	326	1,397	2,004	4,502	1,602
80%	1,412	1,217	456	202	191	189	196	218	824	1,812	4,198	1,399
90%	1,298	1,110	222	188	186	187	190	188	272	1,471	3,961	1,323
Long Term												
Full Simulation Period ^b	6,320	5,459	3,962	2,015	786	573	761	1,307	2,527	3,544	5,733	5,585
Water Year Types ^c												
Wet (32%)	4,370	3,158	1,166	437	202	202	225	319	1,019	1,619	4,183	1,371
Above Normal (16%)	7,918	5,626	3,329	851	275	229	264	484	1,882	2,111	4,271	3,089
Below Normal (13%)	4,510	4,152	4,004	2,297	836	671	811	1,339	2,771	3,082	5,111	7,668
Dry (24%)	6,869	6,488	5,652	3,088	1,075	599	870	1,632	3,030	4,941	7,136	8,778
Critical (15%)	9,556	9,748	7,846	4,647	2,075	1,615	2,228	3,767	5,434	7,359	8,905	10,190

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	166	326	4	-1,764	-1,134	-615	-178	-92	2	-52	-240	34
20%	112	6	-2,035	-1,865	-497	-94	-329	-17	161	-168	-130	-65
30%	330	-16	-3,696	-1,524	-332	-89	-409	-223	313	-109	-259	41
40%	278	-1,877	-3,717	-1,177	-183	-85	-330	-402	487	117	-336	-3
50%	-480	-5,464	-2,863	-559	-70	-22	-192	-377	154	-82	-284	-653
60%	-5,249	-5,342	-1,239	-307	-2	3	-74	-273	185	-229	-83	-4,079
70%	-7,003	-6,646	-827	-29	1	0	-21	-163	-87	-239	-120	-5,400
80%	-6,631	-5,857	-484	1	2	0	2	-4	-125	-78	-284	-5,362
90%	-5,658	-1,974	-118	0	-1	0	2	4	-8	-44	-142	-5,077
Long Term												
Full Simulation Period ^b	-2,567	-2,648	-1,470	-674	-224	-104	-143	-191	113	-116	-180	-2,188
Water Year Types ^c												
Wet (32%)	-3,462	-3,533	-827	-159	-6	-3	-49	-109	49	-118	-116	-4,792
Above Normal (16%)	-1,646	-2,206	-1,859	-469	-61	-7	-101	-248	188	-104	-238	-3,879
Below Normal (13%)	-3,804	-3,082	-2,055	-1,476	-509	-143	-243	-266	482	-115	-403	-1,57
Dry (24%)	-2,456	-2,685	-1,945	-1,148	-305	-120	-192	-175	82	-77	-157	-118
Critical (15%)	-677	-747	-1,114	-485	-475	-365	-221	-265	-118	-194	-91	-25

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.4.5. Sacramento River at Collinsville Salinity, Monthly EC

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	11,466	11,564	9,574	6,827	2,915	2,079	2,268	3,182	4,153	6,528	8,899	10,093
20%	10,165	9,824	9,367	5,863	1,446	1,055	1,498	2,452	3,462	5,402	7,644	9,312
30%	9,811	9,601	8,428	4,565	937	514	1,177	2,185	3,028	4,809	7,272	8,855
40%	9,549	9,369	7,734	2,753	570	406	783	1,403	2,397	3,484	6,003	8,173
50%	9,118	8,800	6,231	1,781	351	267	514	1,075	2,139	3,014	5,252	7,538
60%	8,747	8,357	4,144	797	217	206	316	723	1,804	2,442	4,820	7,164
70%	8,473	8,056	1,856	251	197	194	239	488	1,484	2,243	4,622	7,002
80%	8,043	7,074	940	202	189	189	195	222	949	1,891	4,481	6,761
90%	6,957	3,084	340	189	187	186	187	184	280	1,515	4,102	6,400
Long Term												
Full Simulation Period ^b	8,887	8,107	5,432	2,689	1,009	677	904	1,498	2,415	3,660	5,913	7,773
Water Year Types ^c												
Wet (32%)	7,833	6,691	1,993	596	208	206	274	428	970	1,737	4,299	6,163
Above Normal (16%)	9,564	7,831	5,188	1,319	337	236	365	733	1,694	2,215	4,509	6,968
Below Normal (13%)	8,314	7,234	6,059	3,773	1,345	814	1,055	1,605	2,288	3,197	5,514	7,826
Dry (24%)	9,325	9,173	7,597	4,236	1,380	719	1,062	1,807	2,948	5,018	7,294	8,896
Critical (15%)	10,233	10,495	8,960	5,132	2,549	1,979	2,449	4,032	5,552	7,552	8,997	10,215

Alternative 3

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	11,473	11,766	9,549	5,787	1,874	1,443	2,034	3,312	4,091	6,476	8,774	10,265
20%	10,316	10,036	9,229	4,708	962	974	1,448	2,492	3,643	5,299	7,615	9,272
30%	10,004	9,582	8,343	3,924	635	404	960	2,126	3,317	4,823	6,941	8,790
40%	9,525	9,380	7,191	1,805	387	347	700	1,558	2,966	3,326	5,638	7,814
50%	9,090	9,062	6,196	1,292	276	246	478	1,211	2,453	2,926	4,922	7,392
60%	8,738	8,417	4,254	537	212	203	300	808	2,026	2,259	4,719	7,055
70%	8,546	7,940	1,444	225	196	194	245	483	1,562	2,095	4,431	6,842
80%	8,062	7,019	924	200	190	189	195	260	1,055	1,881	4,283	6,655
90%	7,063	3,108	346	189	187	186	187	184	321	1,503	3,965	6,417
Long Term												
Full Simulation Period ^b	8,974	8,210	5,317	2,300	801	573	848	1,520	2,604	3,586	5,768	7,701
Water Year Types ^c												
Wet (32%)	7,796	6,755	1,924	491	202	207	273	471	1,124	1,679	4,162	6,134
Above Normal (16%)	9,825	7,890	4,901	1,000	262	224	349	768	1,940	2,155	4,365	6,907
Below Normal (13%)	8,504	7,415	6,070	2,839	866	676	979	1,668	2,876	3,070	5,050	7,399
Dry (24%)	9,320	9,273	7,532	3,550	1,062	596	973	1,844	3,079	4,904	7,199	8,884
Critical (15%)	10,461	10,663	8,736	5,052	2,188	1,613	2,307	3,932	5,486	7,543	9,042	10,260

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	7	202	-25	-1,040	-1,041	-636	-234	130	-62	-52	-125	172
20%	151	212	-138	-1,155	-484	-81	-50	40	182	-103	-29	-40
30%	193	-18	-86	-641	-303	-111	-217	-59	289	14	-332	-64
40%	-25	11	-543	-947	-183	-58	-83	154	569	-158	-365	-359
50%	-29	262	-36	-489	-75	-21	-37	137	313	-88	-329	-146
60%	-9	60	110	-260	-5	-3	-15	85	222	-183	-101	-109
70%	73	-116	-411	-26	-1	0	6	-5	78	-149	-191	-160
80%	19	-55	-16	-2	0	-1	0	38	106	-9	-198	-106
90%	106	25	6	0	0	0	0	0	41	-12	-137	17
Long Term												
Full Simulation Period ^b	87	103	-115	-388	-209	-103	-56	22	189	-74	-145	-73
Water Year Types ^c												
Wet (32%)	-37	64	-70	-105	-6	2	-1	43	154	-59	-137	-29
Above Normal (16%)	261	59	-287	-320	-75	-12	-16	36	246	-60	-144	-61
Below Normal (13%)	190	181	11	-933	-479	-138	-76	63	588	-128	-464	-427
Dry (24%)	-5	100	-65	-686	-318	-123	-90	36	131	-114	-95	-12
Critical (15%)	228	168	-224	-80	-361	-366	-141	-100	-65	-10	45	45

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.4.6. Sacramento River at Collinsville Salinity, Monthly EC

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	11,466	11,564	9,574	6,827	2,915	2,079	2,268	3,182	4,153	6,528	8,899	10,093
20%	10,165	9,824	9,367	5,863	1,446	1,055	1,498	2,452	3,462	5,402	7,644	9,312
30%	9,811	9,601	8,428	4,565	937	514	1,177	2,185	3,028	4,809	7,272	8,855
40%	9,549	9,369	7,734	2,753	570	406	783	1,403	2,397	3,484	6,003	8,173
50%	9,118	8,800	6,231	1,781	351	267	514	1,075	2,139	3,014	5,252	7,538
60%	8,747	8,357	4,144	797	217	206	316	723	1,804	2,442	4,820	7,164
70%	8,473	8,056	1,856	251	197	194	239	488	1,484	2,243	4,622	7,002
80%	8,043	7,074	940	202	189	189	195	222	949	1,891	4,481	6,761
90%	6,957	3,084	340	189	187	186	187	184	280	1,515	4,102	6,400
Long Term												
Full Simulation Period ^b	8,887	8,107	5,432	2,689	1,009	677	904	1,498	2,415	3,660	5,913	7,773
Water Year Types ^c												
Wet (32%)	7,833	6,691	1,993	596	208	206	274	428	970	1,737	4,299	6,163
Above Normal (16%)	9,564	7,831	5,188	1,319	337	236	365	733	1,694	2,215	4,509	6,968
Below Normal (13%)	8,314	7,234	6,059	3,773	1,345	814	1,055	1,605	2,288	3,197	5,514	7,826
Dry (24%)	9,325	9,173	7,597	4,236	1,380	719	1,062	1,807	2,948	5,018	7,294	8,896
Critical (15%)	10,233	10,495	8,960	5,132	2,549	1,979	2,449	4,032	5,552	7,552	8,997	10,215

Alternative 5

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	11,705	11,663	9,569	5,052	1,782	1,468	1,727	2,525	4,035	6,427	8,485	9,986
20%	10,368	9,986	7,171	4,034	950	978	1,075	1,987	3,386	5,074	7,505	9,231
30%	10,121	9,585	4,758	3,042	605	424	675	1,614	3,293	4,676	6,975	8,848
40%	9,781	7,463	3,988	1,630	387	319	431	939	2,780	3,601	5,629	8,104
50%	8,583	3,273	3,366	1,222	281	246	321	651	2,291	2,939	4,979	6,741
60%	3,488	2,950	2,905	488	215	208	242	459	1,984	2,219	4,721	3,119
70%	1,470	1,410	1,021	222	198	193	218	303	1,388	2,016	4,472	1,600
80%	1,413	1,219	460	202	191	189	198	218	825	1,814	4,170	1,404
90%	1,295	1,110	222	188	186	187	190	188	273	1,488	3,890	1,324
Long Term												
Full Simulation Period ^b	6,311	5,440	3,967	2,039	804	574	682	1,148	2,424	3,494	5,684	5,571
Water Year Types ^c												
Wet (32%)	4,367	3,175	1,168	437	202	202	224	306	1,015	1,598	4,138	1,371
Above Normal (16%)	7,893	5,516	3,295	850	275	229	264	474	1,874	2,111	4,272	3,103
Below Normal (13%)	4,522	4,157	4,009	2,301	835	670	725	1,189	2,726	3,065	5,071	7,586
Dry (24%)	6,861	6,468	5,682	3,112	1,081	600	739	1,414	2,917	4,887	7,081	8,770
Critical (15%)	9,529	9,725	7,860	4,772	2,188	1,625	1,993	3,221	4,976	7,175	8,795	10,167

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	239	99	-5	-1,775	-1,133	-611	-541	-657	-118	-101	-414	-107
20%	203	162	-2,196	-1,830	-496	-77	-423	-465	-76	-328	-139	-82
30%	310	-16	-3,670	-1,524	-333	-91	-503	-572	266	-134	-297	-7
40%	232	-1,906	-3,745	-1,123	-183	-86	-352	-465	383	118	-373	-69
50%	-535	-5,527	-2,866	-559	-70	-20	-193	-424	152	-75	-273	-797
60%	-5,259	-5,408	-1,239	-309	-2	2	-74	-264	180	-222	-99	-4,045
70%	-7,003	-6,646	-834	-29	1	0	-21	-185	-96	-228	-150	-5,403
80%	-6,630	-5,855	-480	0	2	0	3	-5	-124	-76	-312	-5,357
90%	-5,661	-1,974	-118	0	0	0	2	4	-8	-28	-212	-5,076
Long Term												
Full Simulation Period ^b	-2,576	-2,667	-1,465	-649	-206	-102	-222	-350	10	-166	-230	-2,202
Water Year Types ^c												
Wet (32%)	-3,465	-3,516	-825	-159	-6	-3	-50	-122	45	-139	-161	-4,792
Above Normal (16%)	-1,671	-2,315	-1,893	-470	-61	-7	-101	-259	180	-105	-237	-3,865
Below Normal (13%)	-3,792	-3,077	-2,049	-1,471	-510	-144	-329	-416	438	-133	-443	-240
Dry (24%)	-2,463	-2,705	-1,916	-1,124	-299	-119	-324	-393	-31	-130	-213	-126
Critical (15%)	-705	-770	-1,100	-360	-361	-355	-455	-811	-575	-378	-201	-47

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 **B.5. Sacramento River at Mallard Slough Salinity**

Figure 6E.B.5.1. Sacramento River at Mallard Slough Salinity, Electrical Conductivity, October

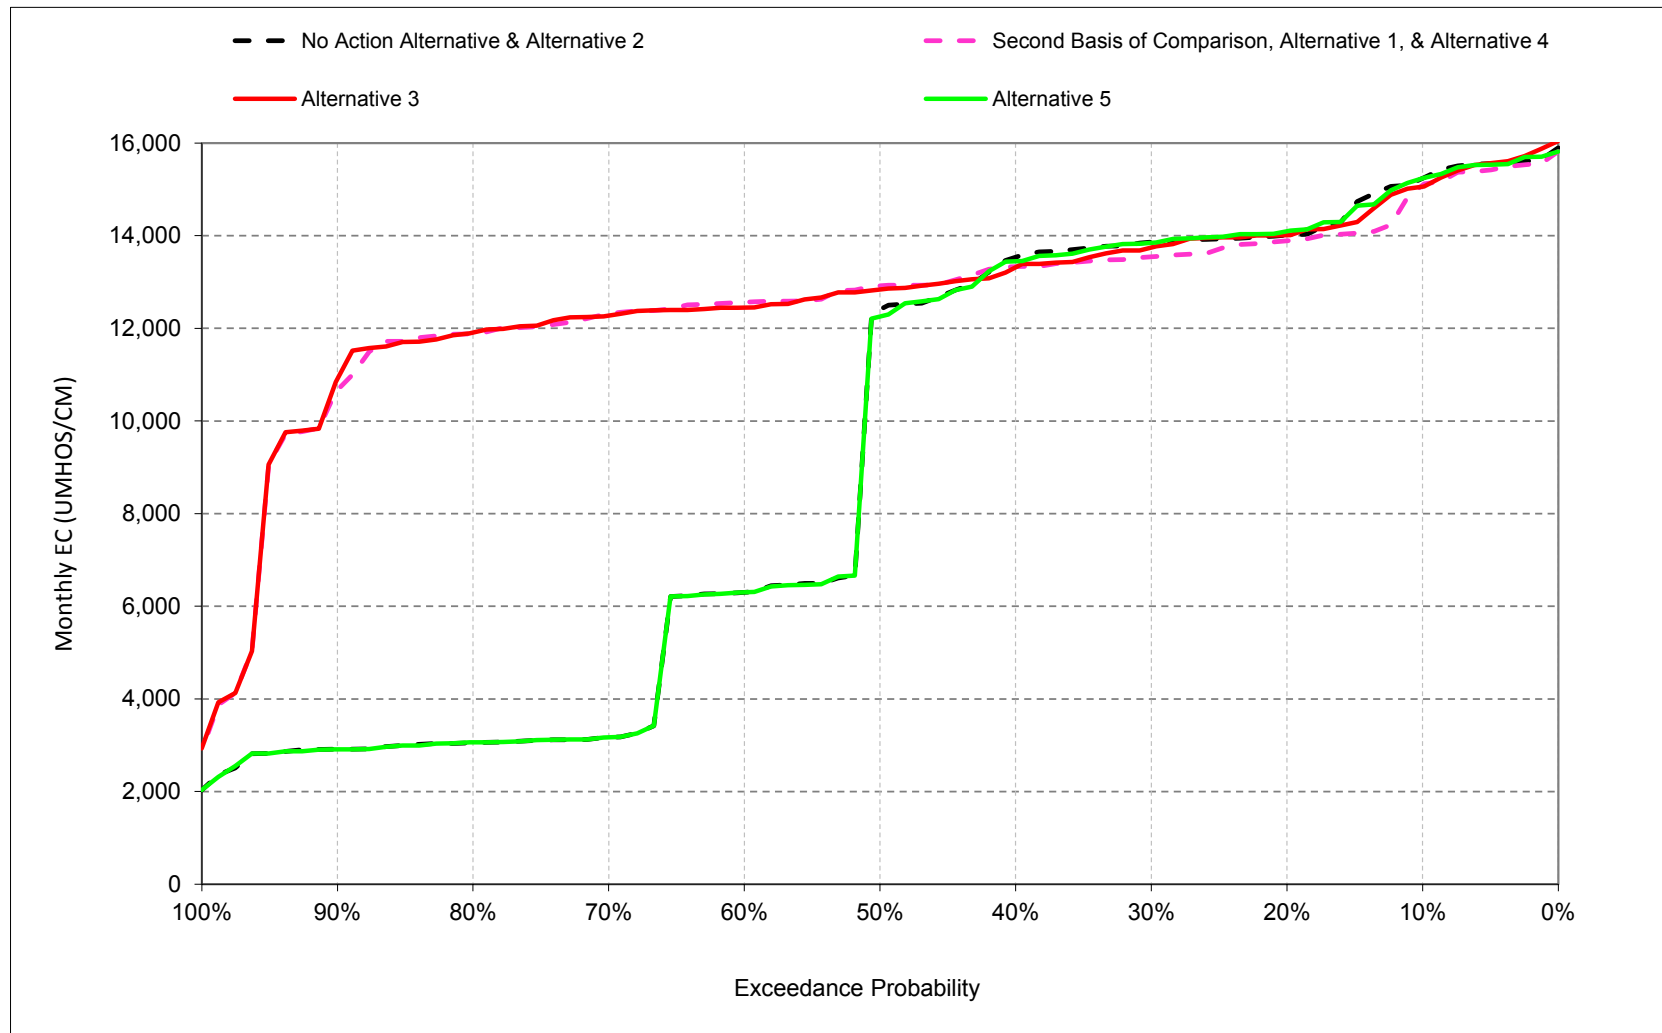


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.5.2. Sacramento River at Mallard Slough Salinity, Electrical Conductivity, November

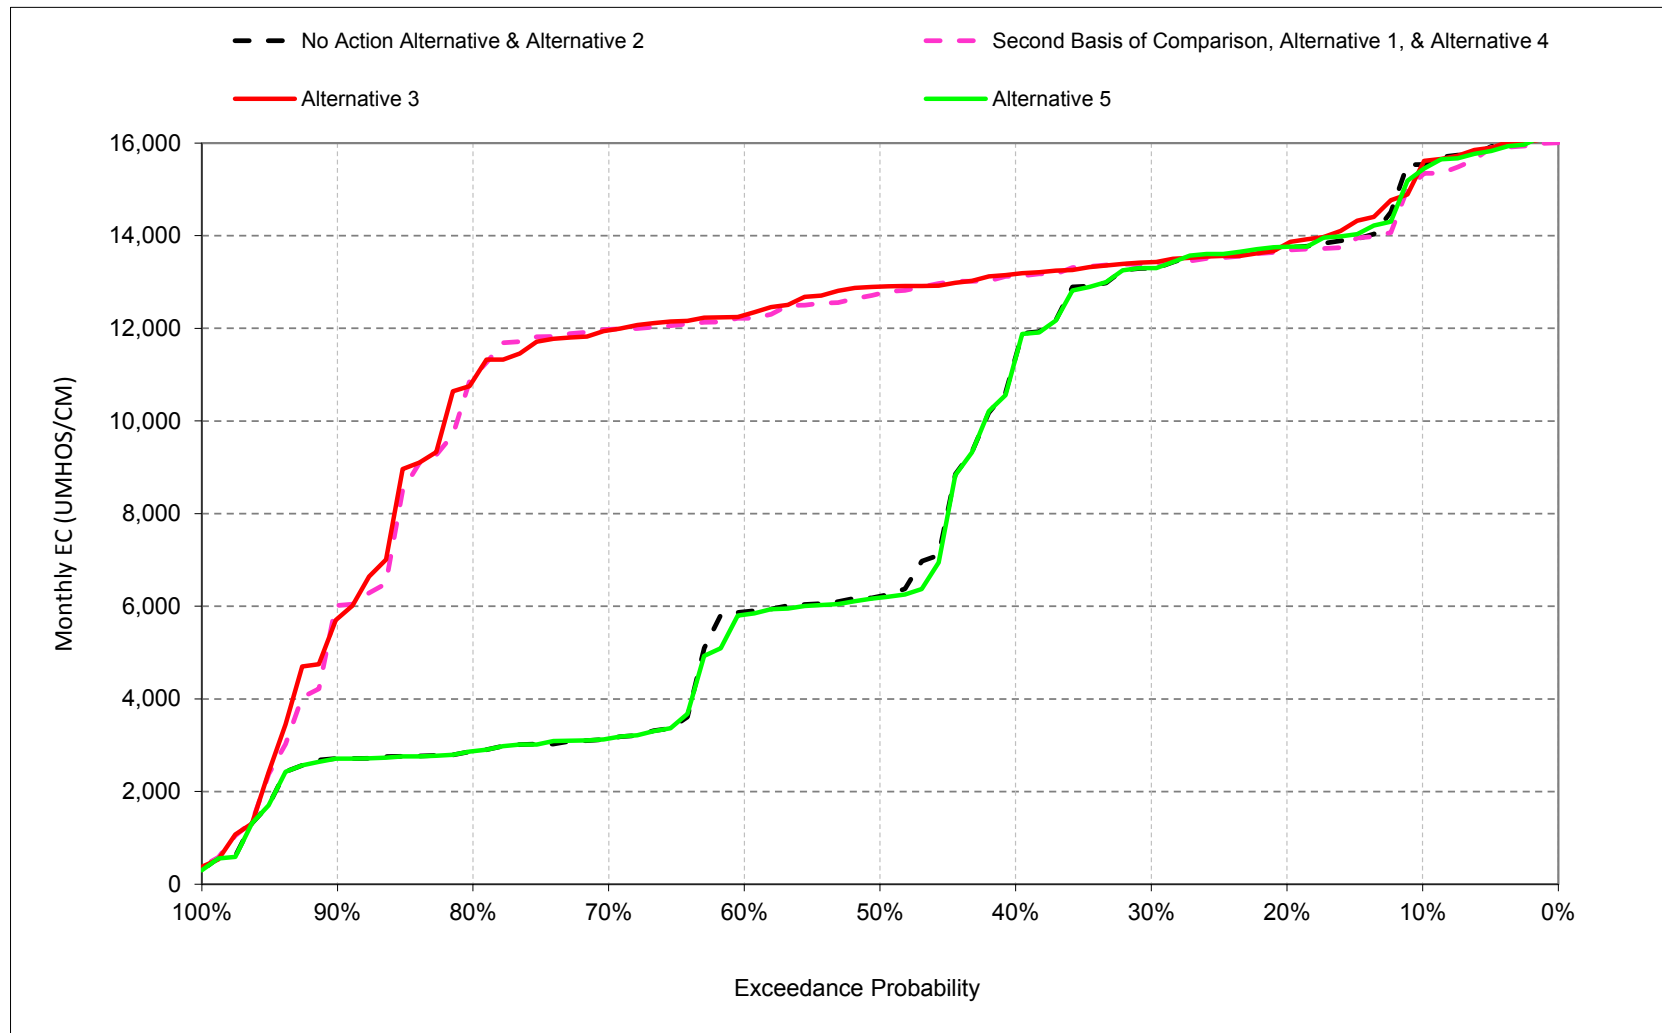


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.5.3. Sacramento River at Mallard Slough Salinity, Electrical Conductivity, December

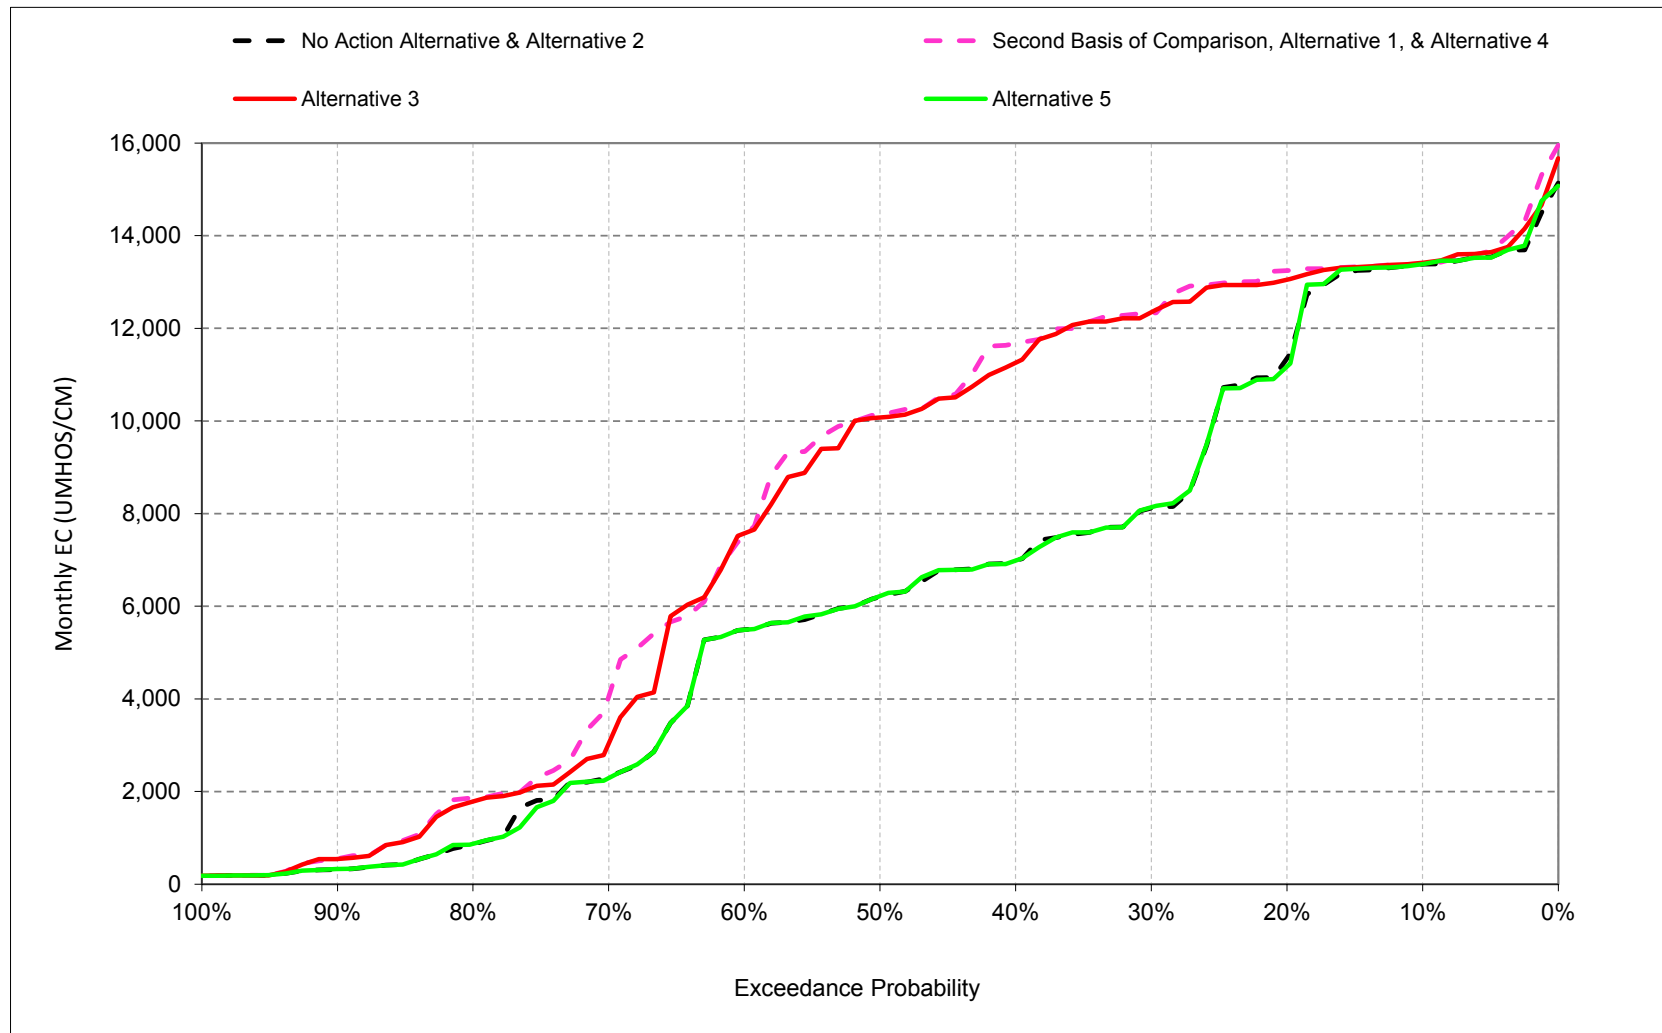


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.5.4. Sacramento River at Mallard Slough Salinity, Electrical Conductivity, January

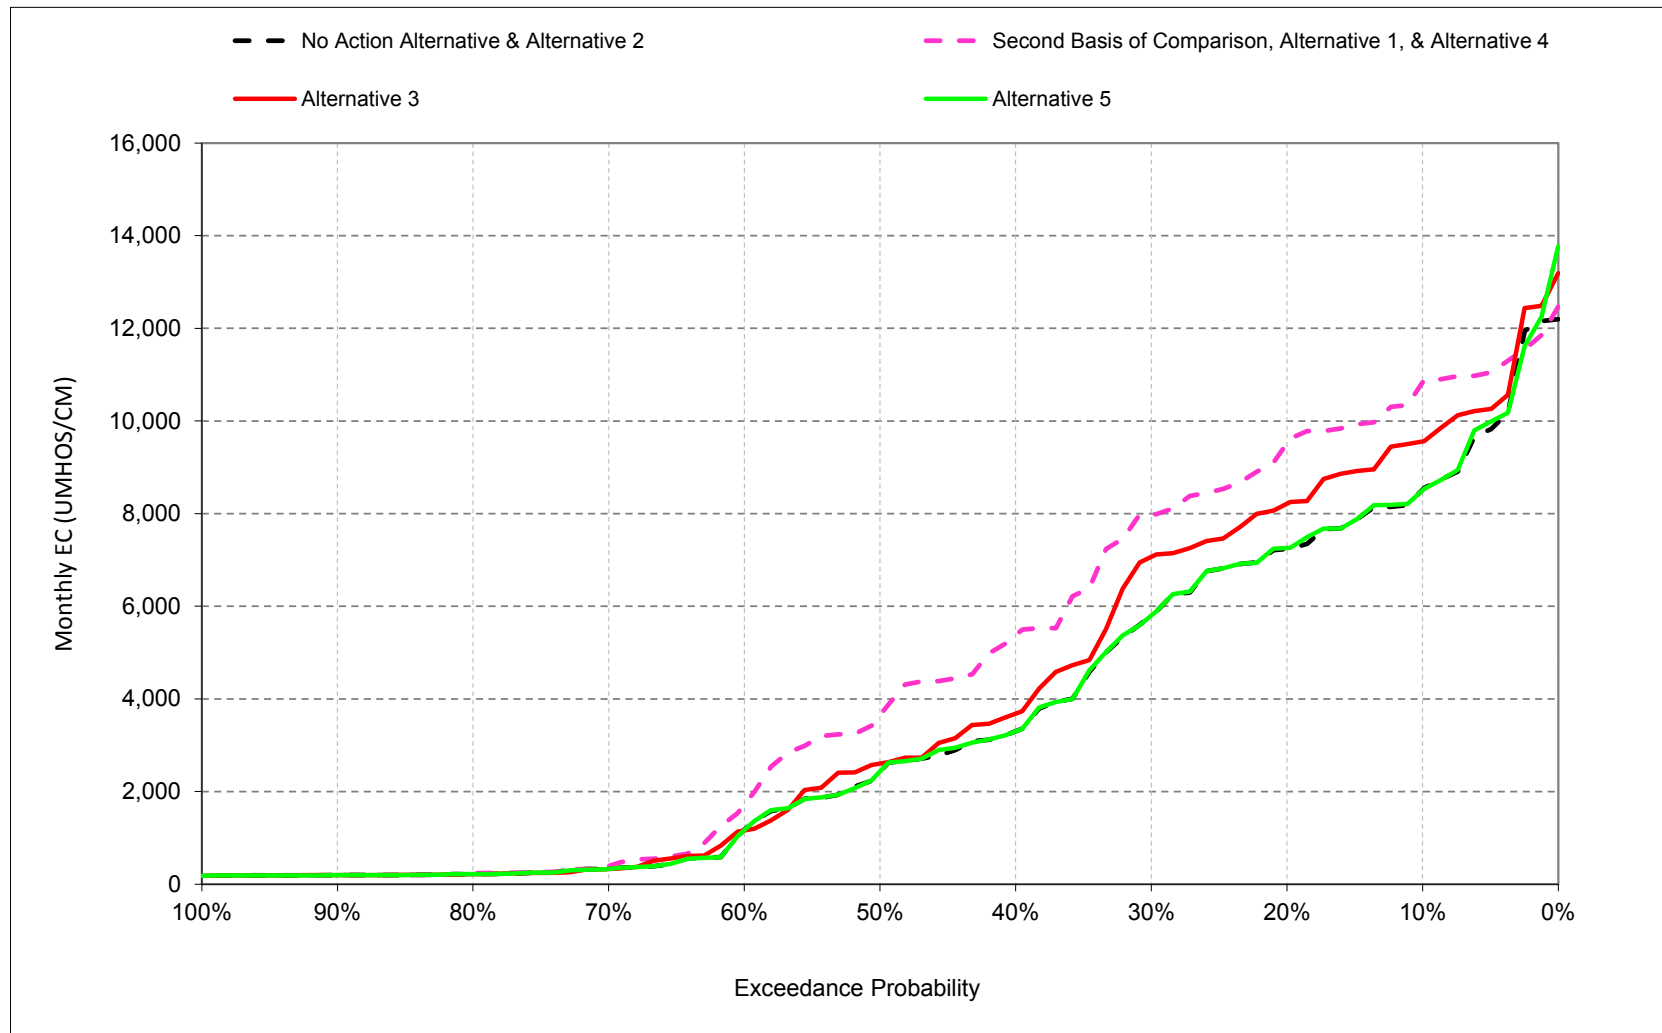


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.5.5. Sacramento River at Mallard Slough Salinity, Electrical Conductivity, February

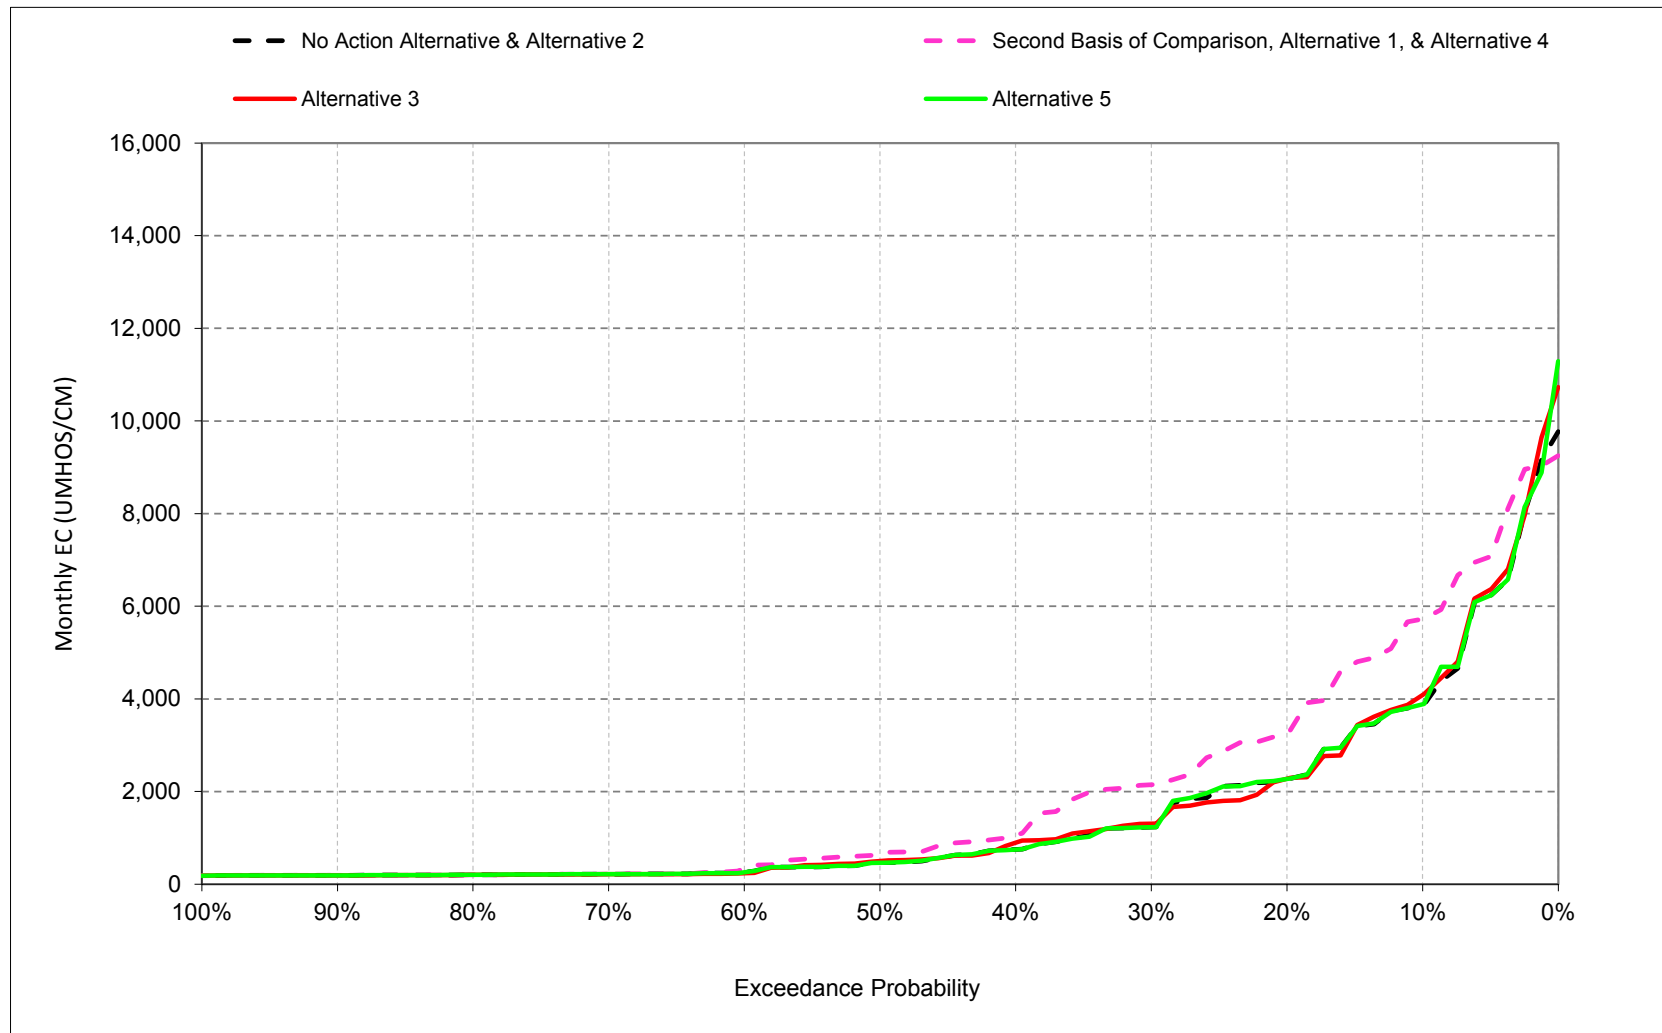


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.5.6. Sacramento River at Mallard Slough Salinity, Electrical Conductivity, March

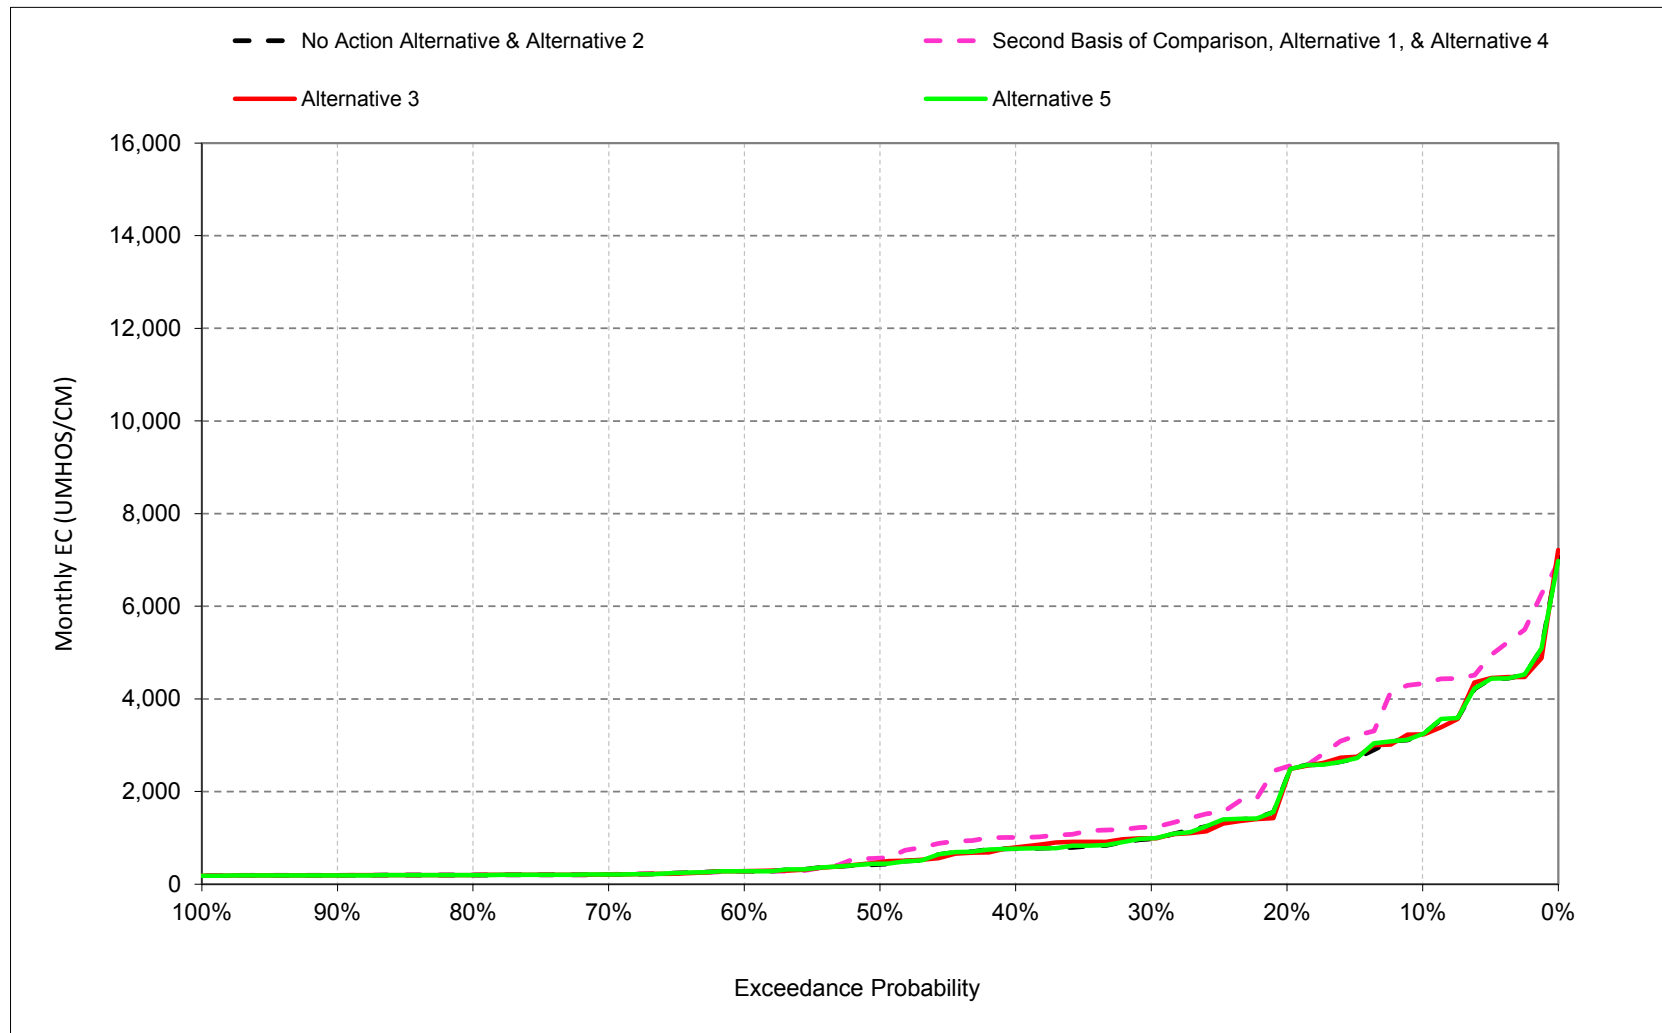


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.5.7. Sacramento River at Mallard Slough Salinity, Electrical Conductivity, April

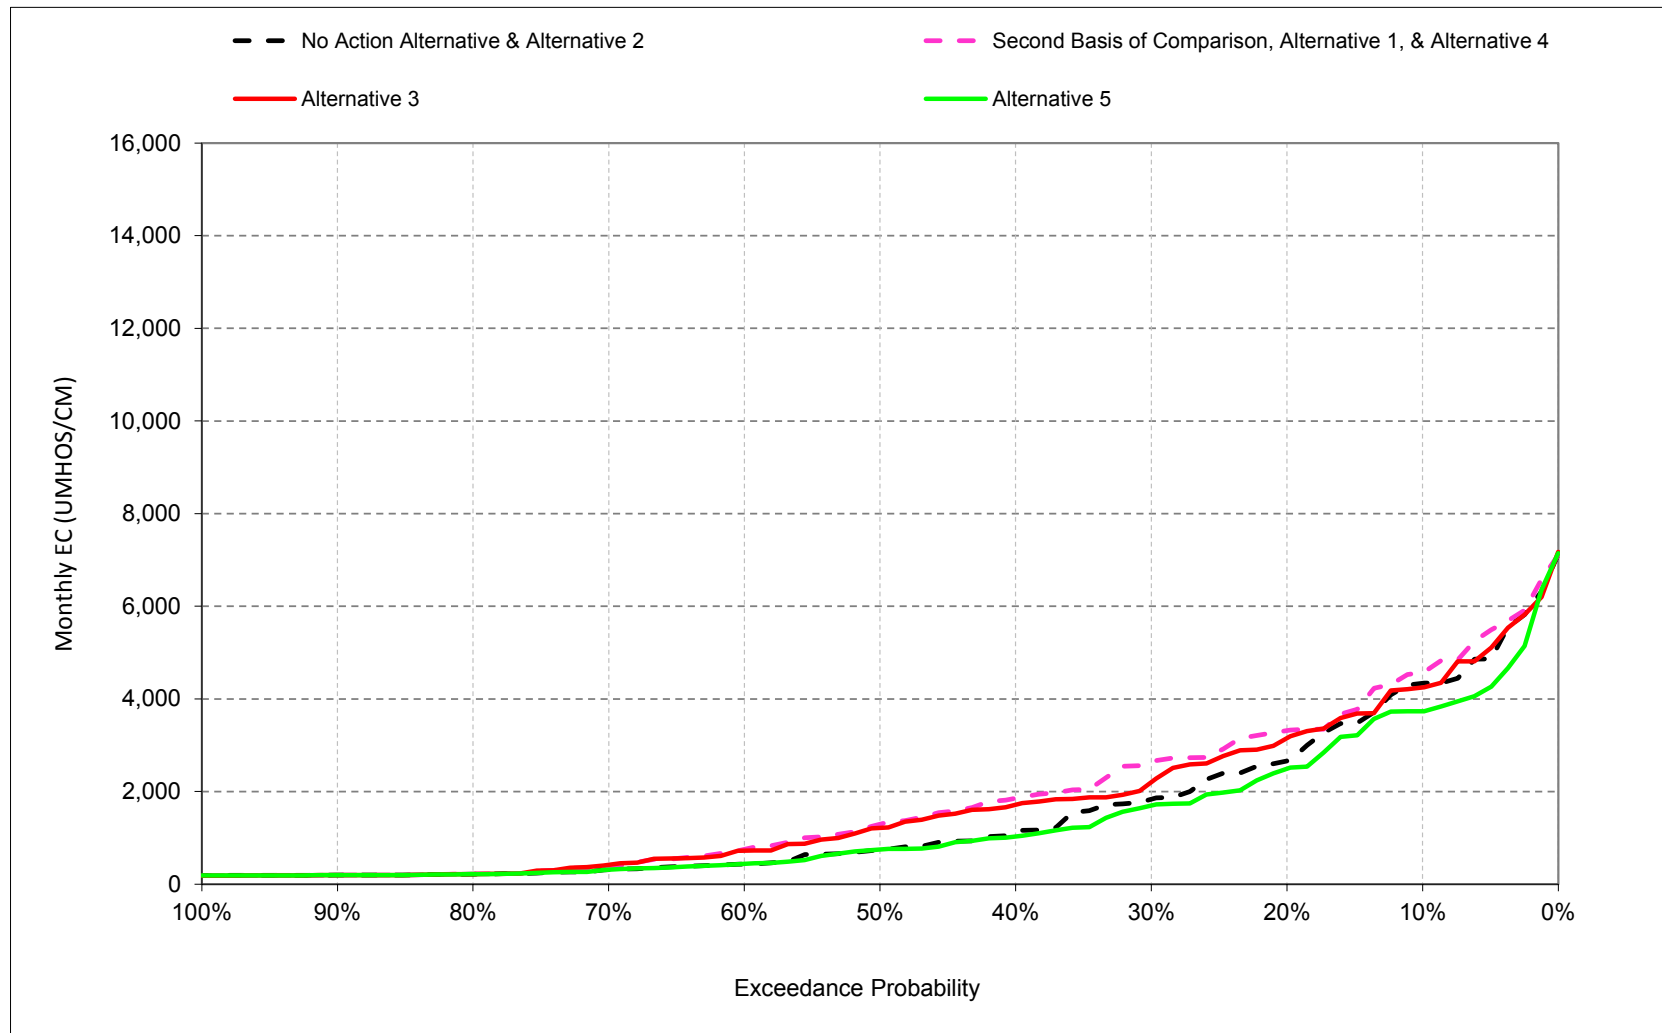


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.5.8. Sacramento River at Mallard Slough Salinity, Electrical Conductivity, May

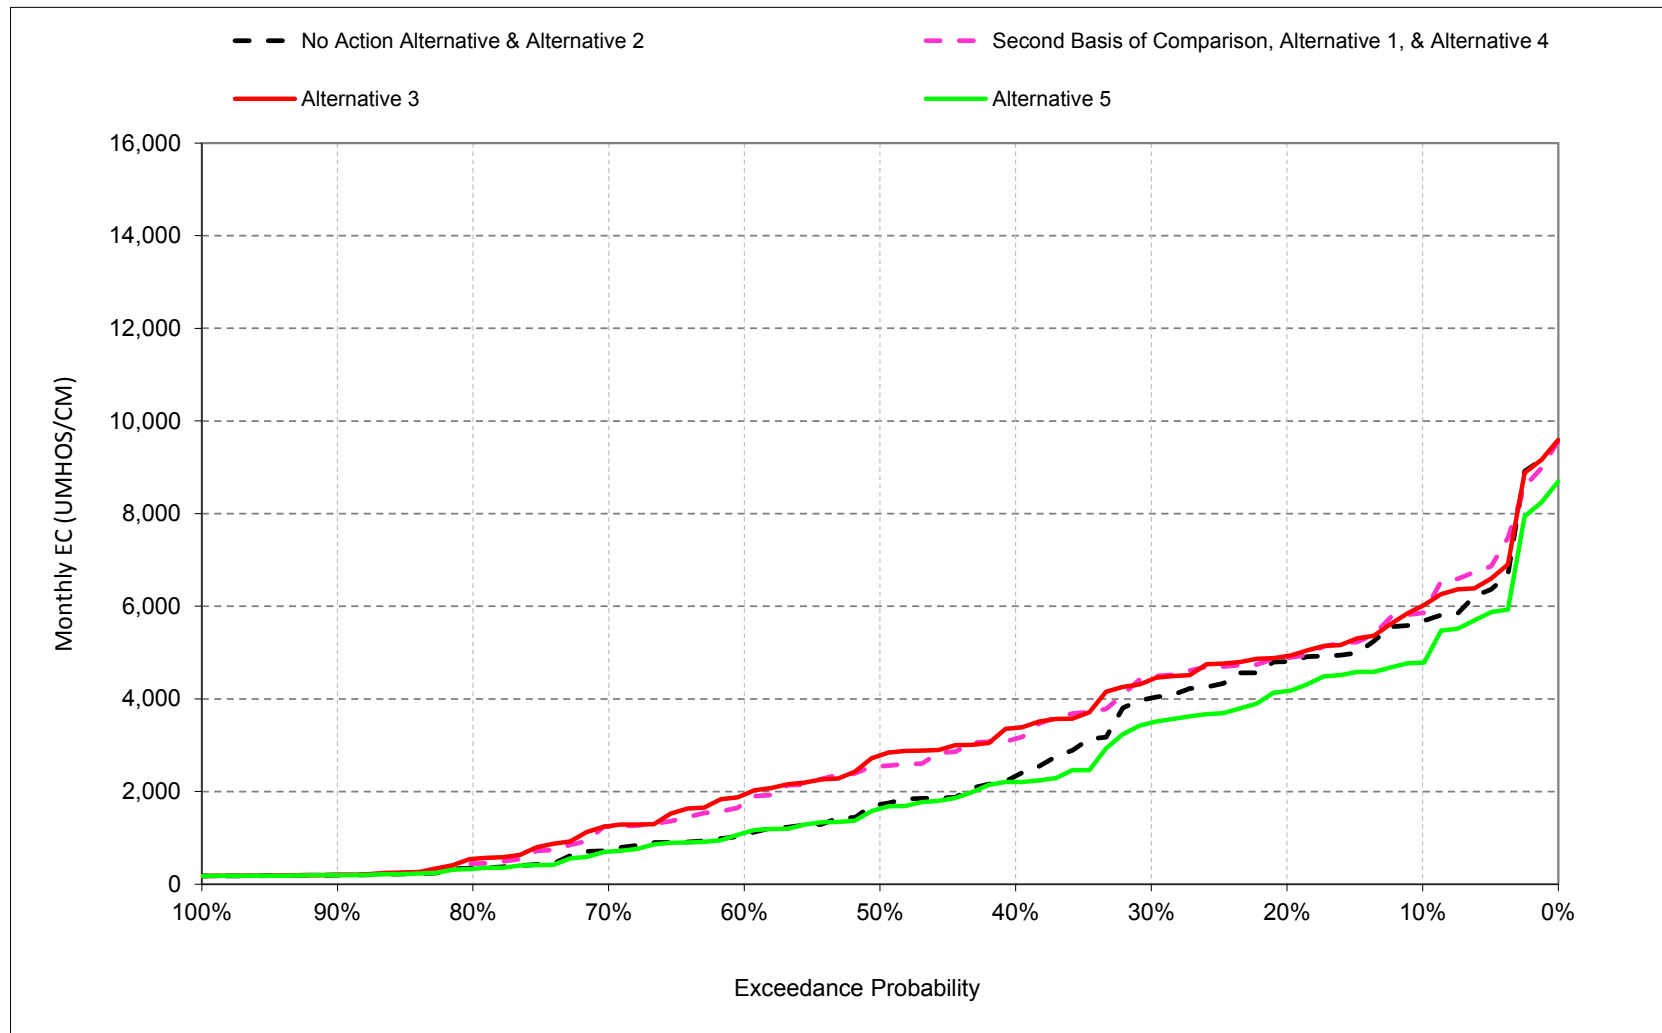


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.5.9. Sacramento River at Mallard Slough Salinity, Electrical Conductivity, June

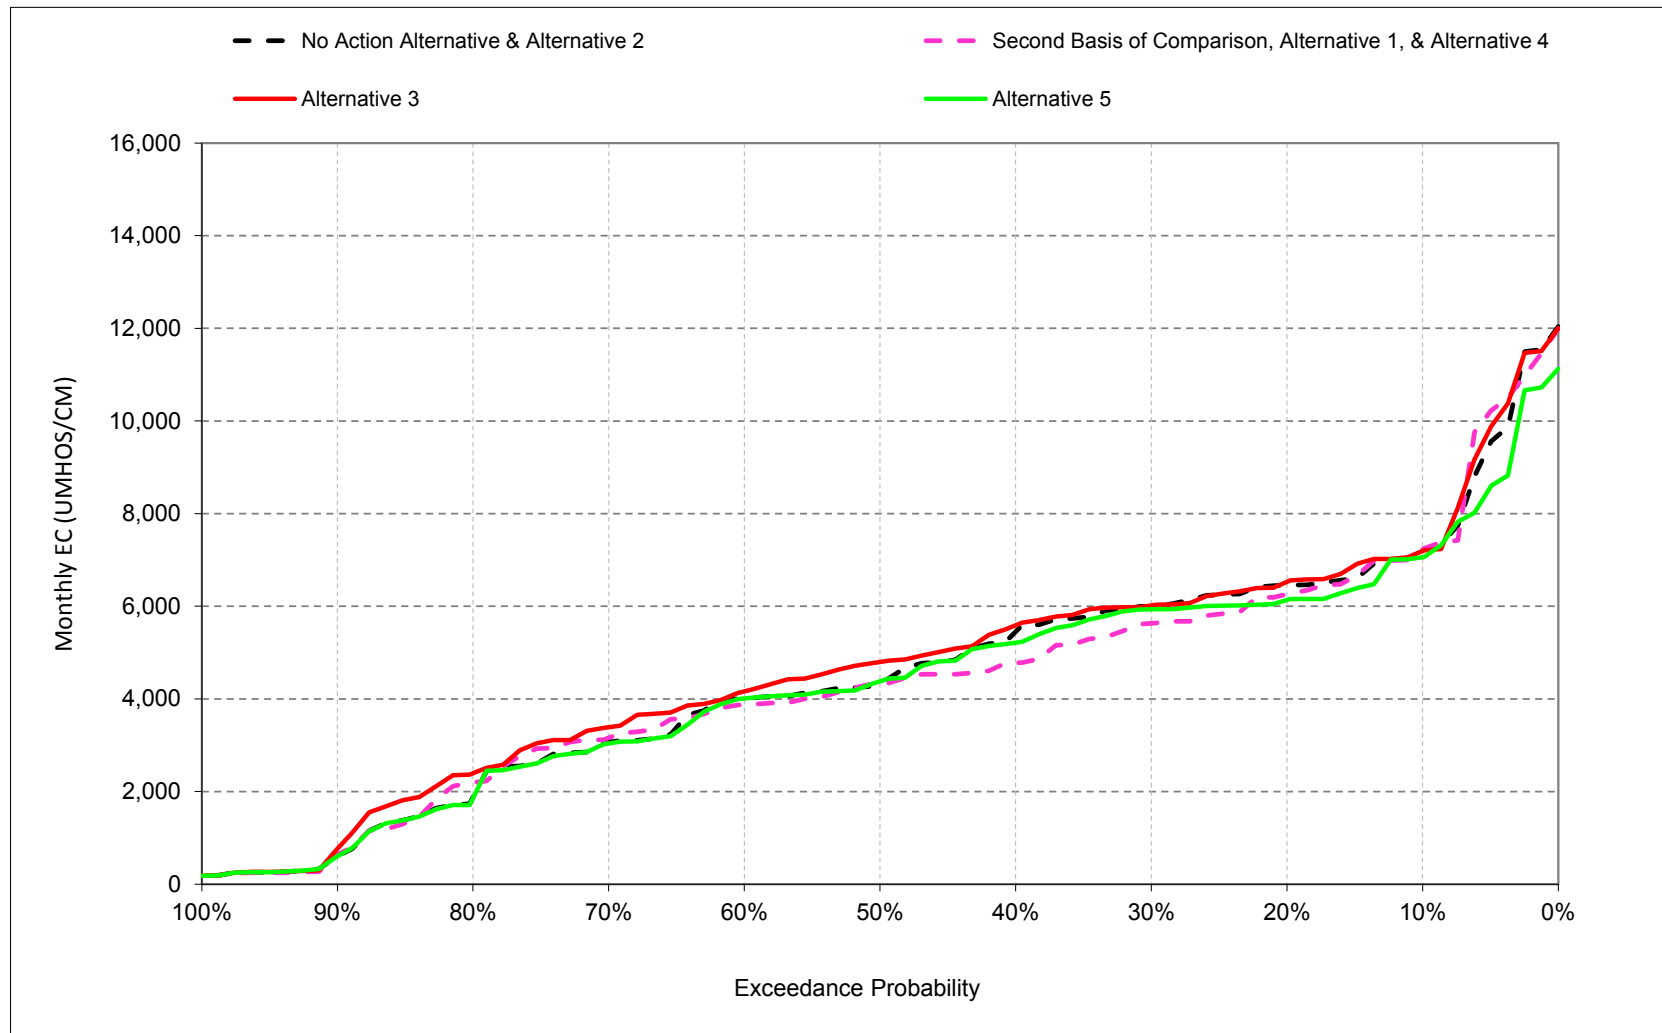


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.5.10. Sacramento River at Mallard Slough Salinity, Electrical Conductivity, July

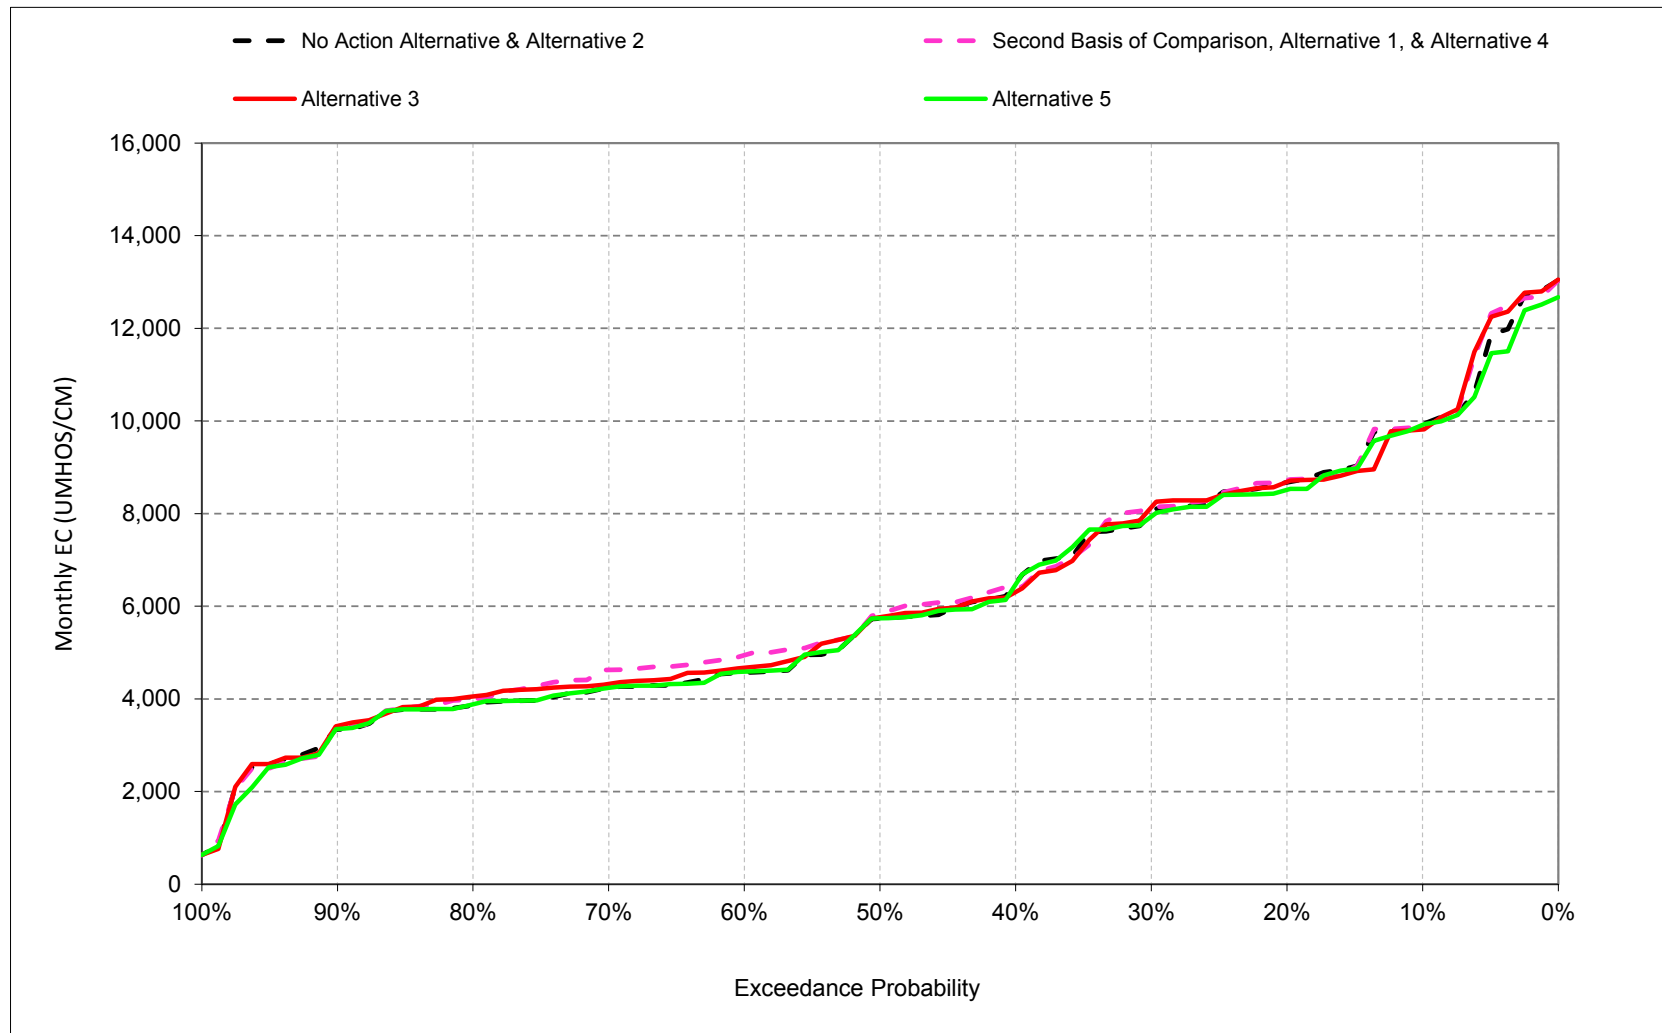


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.5.11. Sacramento River at Mallard Slough Salinity, Electrical Conductivity, August

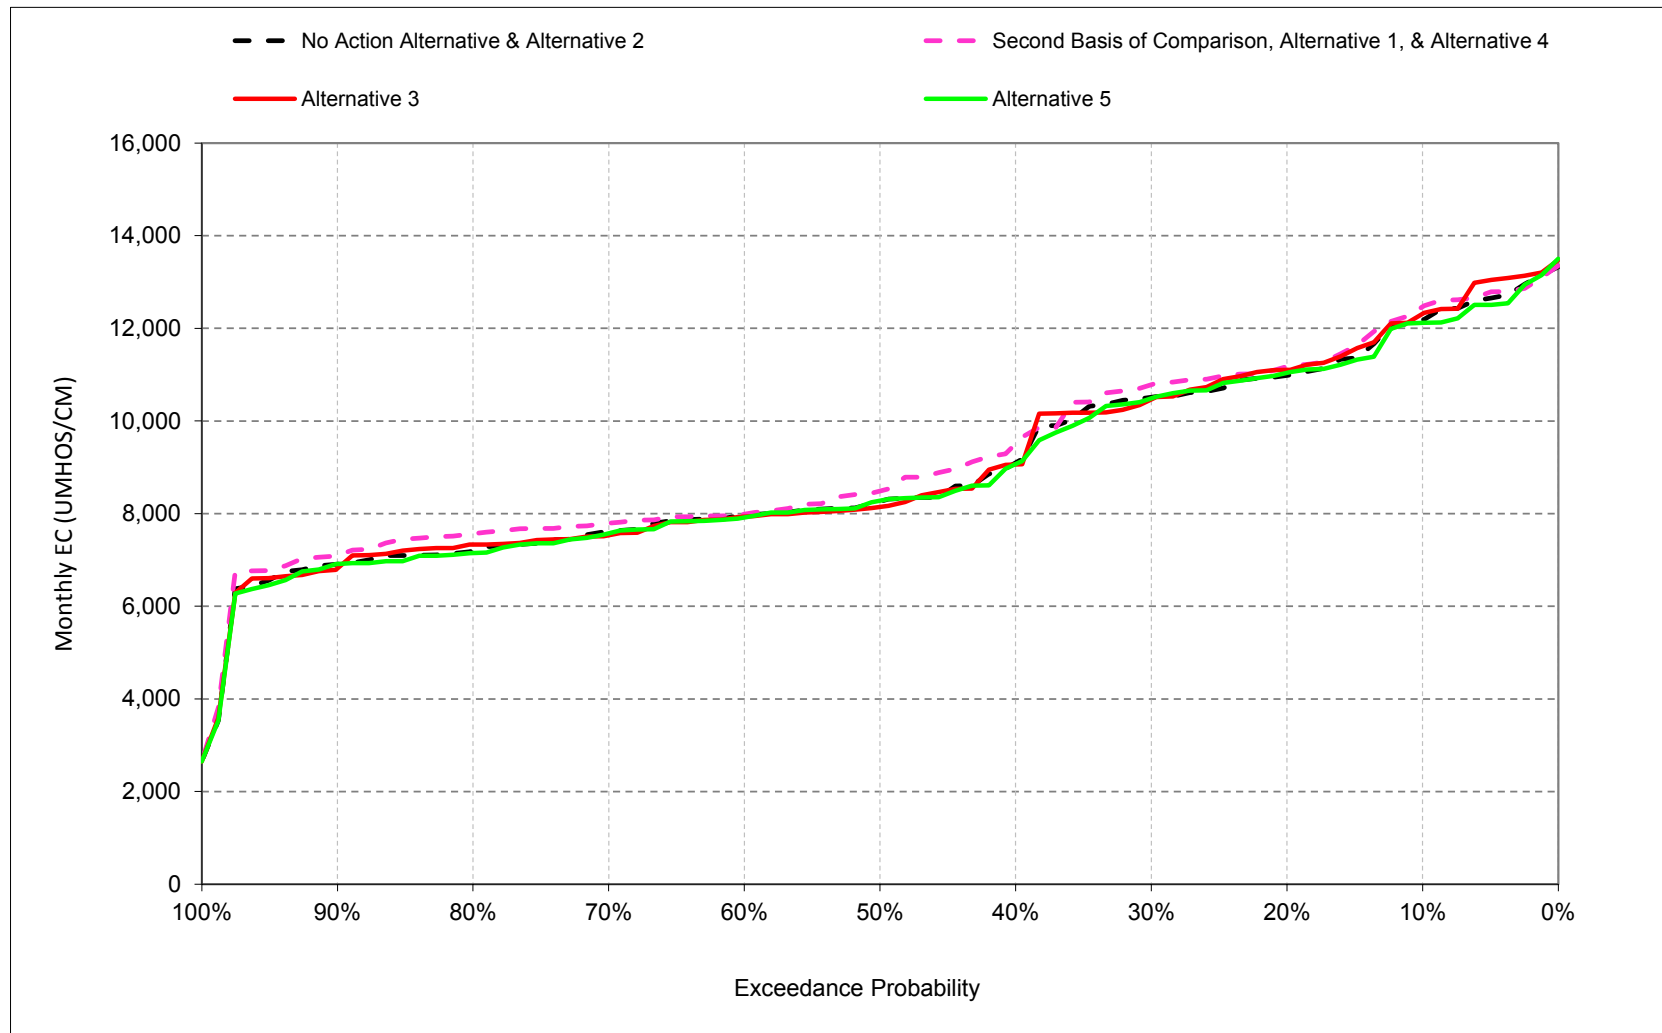

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.5.12. Sacramento River at Mallard Slough Salinity, Electrical Conductivity, September

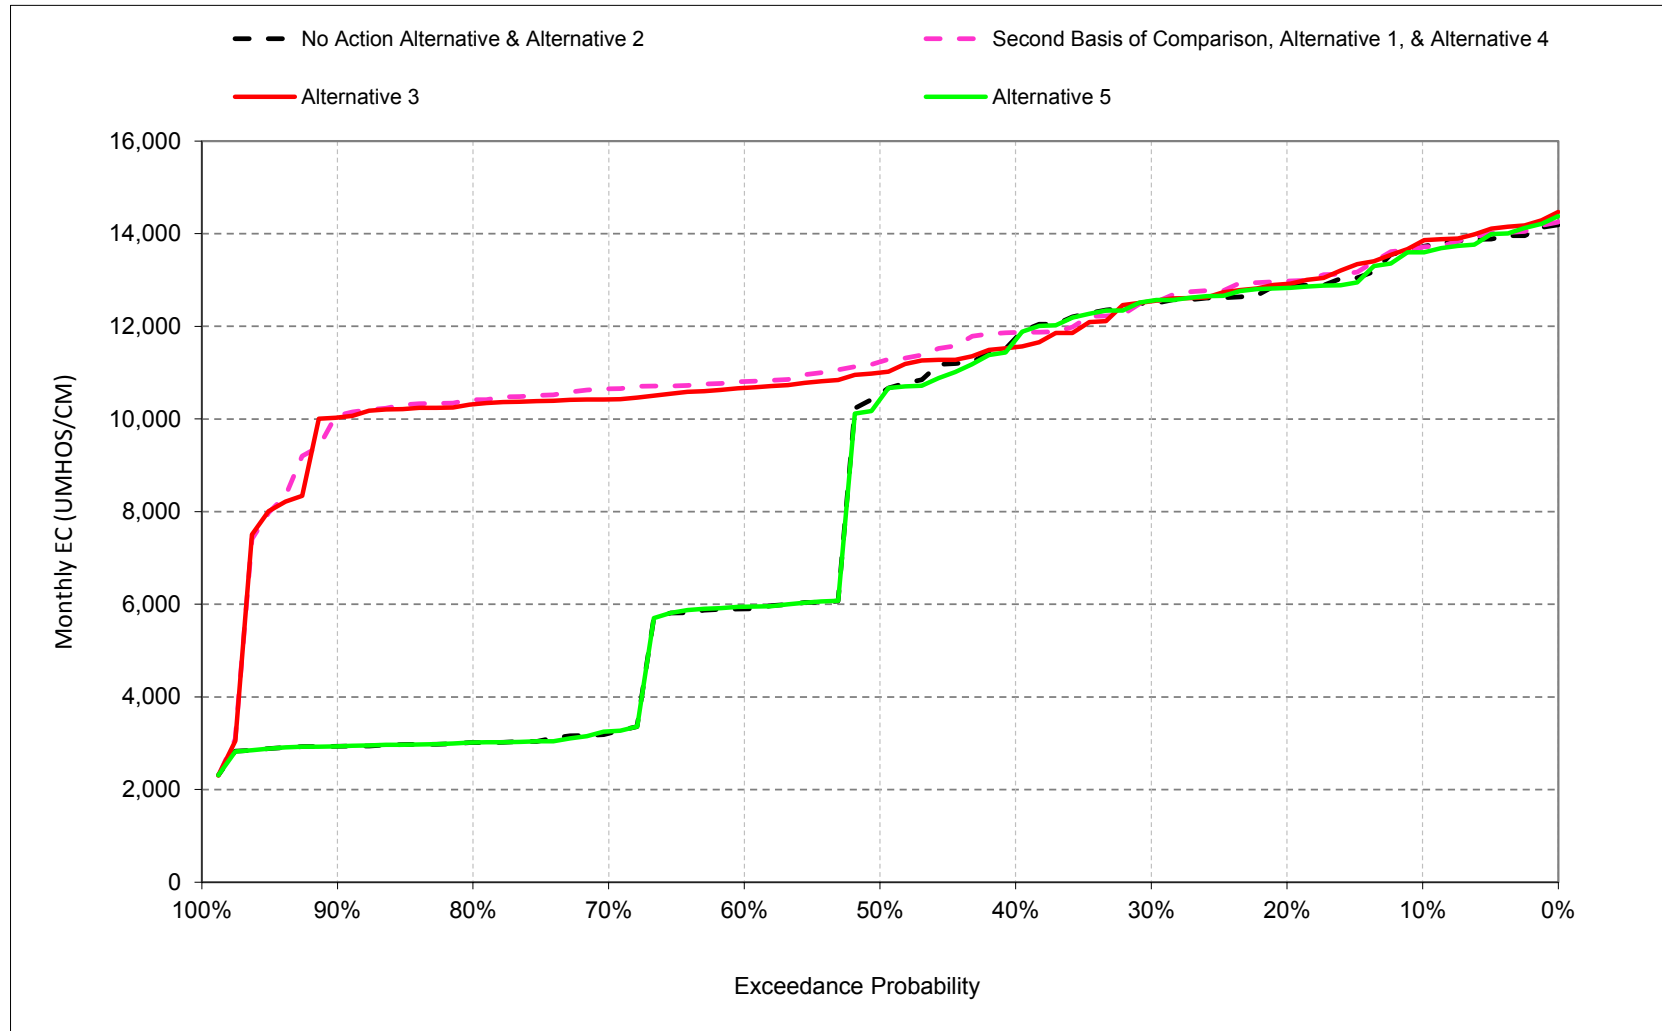

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.5.1. Sacramento River at Mallard Slough Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	15,237	15,536	13,384	8,515	3,874	3,239	4,335	5,680	7,198	9,928	12,185	13,719
20%	14,012	13,740	11,351	7,235	2,267	2,304	2,663	4,804	6,453	8,676	10,986	12,881
30%	13,861	13,299	8,120	5,800	1,231	978	1,835	4,016	6,001	7,995	10,513	12,500
40%	13,538	11,380	6,987	3,300	751	768	1,116	2,335	5,450	6,496	9,098	11,747
50%	12,409	6,217	6,205	2,430	463	428	742	1,724	4,356	5,735	8,265	10,544
60%	6,299	5,882	5,494	1,171	259	279	434	1,068	4,011	4,567	7,965	5,899
70%	3,172	3,144	2,322	335	218	209	313	743	3,067	4,239	7,617	3,301
80%	3,053	2,870	865	218	202	197	214	347	1,874	3,867	7,199	3,016
90%	2,914	2,710	319	194	192	192	196	198	601	3,339	6,910	2,938
Long Term												
Full Simulation Period ^b	9,172	8,228	6,310	3,544	1,486	1,142	1,535	2,514	4,524	6,181	8,988	8,454
Water Year Types^c												
Wet (32%)	6,802	5,359	2,156	746	239	263	337	600	2,026	3,434	7,135	2,988
Above Normal (16%)	11,047	8,470	5,608	1,574	459	352	482	1,112	3,727	4,399	7,324	5,906
Below Normal (13%)	6,911	6,624	6,658	4,288	1,703	1,514	1,817	2,841	5,141	5,934	8,443	11,307
Dry (24%)	9,942	9,655	8,869	5,570	2,142	1,279	1,905	3,351	5,537	8,238	10,656	12,439
Critical (15%)	13,064	13,275	11,485	7,685	4,007	3,337	4,399	6,486	8,542	10,858	12,525	13,801

Alternative 1												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	15,090	15,314	13,389	10,837	5,727	4,332	4,576	5,857	7,222	9,867	12,466	13,714
20%	13,893	13,680	13,246	9,520	3,298	2,537	3,316	4,889	6,259	8,724	11,178	12,976
30%	13,545	13,389	12,331	7,985	2,148	1,232	2,636	4,475	5,630	8,118	10,782	12,513
40%	13,332	13,129	11,675	5,376	1,062	1,012	1,856	3,141	4,780	6,416	9,510	11,868
50%	12,917	12,752	10,145	3,654	654	562	1,293	2,552	4,332	5,844	8,488	11,234
60%	12,563	12,217	7,519	1,717	333	276	754	1,751	3,874	4,942	7,987	10,807
70%	12,314	11,977	4,052	393	217	210	379	1,247	3,159	4,624	7,792	10,651
80%	11,890	10,939	1,860	234	203	199	224	444	2,199	3,992	7,567	10,415
90%	10,671	6,016	549	195	191	194	195	201	640	3,386	7,097	10,072
Long Term												
Full Simulation Period ^b	12,558	11,604	8,216	4,552	1,923	1,359	1,857	2,909	4,430	6,308	9,200	11,360
Water Year Types^c												
Wet (32%)	11,338	9,856	3,407	1,042	262	275	480	866	1,996	3,614	7,282	9,584
Above Normal (16%)	13,300	11,306	8,006	2,349	621	377	770	1,688	3,550	4,561	7,621	10,626
Below Normal (13%)	12,105	10,844	9,298	6,338	2,544	1,773	2,346	3,389	4,596	6,053	8,887	11,489
Dry (24%)	13,074	12,921	11,277	7,247	2,789	1,594	2,328	3,716	5,491	8,252	10,831	12,584
Critical (15%)	13,952	14,214	12,773	8,412	4,920	3,998	4,785	6,873	8,734	11,031	12,635	13,844

Alternative 1 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-147	-222	6	2,321	1,852	1,093	240	177	24	-61	281	-5
20%	-119	-60	1,895	2,285	1,031	233	653	84	-193	48	192	95
30%	-315	90	4,211	2,185	916	254	801	459	-372	122	269	12
40%	-206	1,749	4,688	2,076	311	244	740	806	-669	-80	411	121
50%	508	6,536	3,940	1,224	191	134	552	827	-24	110	223	690
60%	6,263	6,335	2,025	546	74	-3	321	683	-137	376	21	4,908
70%	9,142	8,834	1,731	58	0	1	66	504	92	385	175	7,350
80%	8,837	8,069	995	16	1	2	9	97	325	125	369	7,399
90%	7,757	3,307	230	1	-1	2	-1	3	39	48	188	7,134
Long Term												
Full Simulation Period ^b	3,386	3,376	1,907	1,007	437	216	322	395	-94	127	212	2,906
Water Year Types^c												
Wet (32%)	4,535	4,497	1,251	296	23	12	144	266	-31	180	147	6,596
Above Normal (16%)	2,253	2,837	2,398	776	162	24	287	576	-177	161	297	4,720
Below Normal (13%)	5,194	4,220	2,639	2,050	841	259	530	548	-545	119	444	182
Dry (24%)	3,132	3,266	2,408	1,677	647	316	423	365	-46	15	176	145
Critical (15%)	888	939	1,288	728	914	661	386	387	192	173	110	44

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
^b Based on the 82-year simulation period.
^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.5.2. Sacramento River at Mallard Slough Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	15,237	15,536	13,384	8,515	3,874	3,239	4,335	5,680	7,198	9,928	12,185	13,719
20%	14,012	13,740	11,351	7,235	2,267	2,304	2,663	4,804	6,453	8,676	10,986	12,881
30%	13,861	13,299	8,120	5,800	1,231	978	1,835	4,016	6,001	7,995	10,513	12,500
40%	13,538	11,380	6,987	3,300	751	768	1,116	2,335	5,450	6,496	9,098	11,747
50%	12,409	6,217	6,205	2,430	463	428	742	1,724	4,356	5,735	8,265	10,544
60%	6,299	5,882	5,494	1,171	259	279	434	1,068	4,011	4,567	7,965	5,899
70%	3,172	3,144	2,322	335	218	209	313	743	3,067	4,239	7,617	3,301
80%	3,053	2,870	865	218	202	197	214	347	1,874	3,867	7,199	3,016
90%	2,914	2,710	319	194	192	192	196	198	601	3,339	6,910	2,938
Long Term												
Full Simulation Period ^b	9,172	8,228	6,310	3,544	1,486	1,142	1,535	2,514	4,524	6,181	8,988	8,454
Water Year Types ^c												
Wet (32%)	6,802	5,359	2,156	746	239	263	337	600	2,026	3,434	7,135	2,988
Above Normal (16%)	11,047	8,470	5,608	1,574	459	352	482	1,112	3,727	4,399	7,324	5,906
Below Normal (13%)	6,911	6,624	6,658	4,288	1,703	1,514	1,817	2,841	5,141	5,934	8,443	11,307
Dry (24%)	9,942	9,655	8,869	5,570	2,142	1,279	1,905	3,351	5,537	8,238	10,656	12,439
Critical (15%)	13,064	13,275	11,485	7,685	4,007	3,337	4,399	6,486	8,542	10,858	12,525	13,801
Alternative 3												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	15,057	15,546	13,418	9,561	4,084	3,235	4,246	6,006	7,191	9,816	12,314	13,839
20%	14,010	13,829	13,051	8,216	2,276	2,279	3,152	4,927	6,524	8,685	11,103	12,914
30%	13,745	13,428	12,346	7,068	1,309	990	2,203	4,416	6,017	8,138	10,465	12,542
40%	13,315	13,176	11,259	3,682	896	795	1,716	3,375	5,588	6,304	9,061	11,552
50%	12,840	12,899	10,075	2,606	500	477	1,215	2,780	4,796	5,766	8,142	11,000
60%	12,448	12,287	7,575	1,162	238	283	724	1,939	4,161	4,674	7,935	10,673
70%	12,276	11,957	3,033	329	215	207	418	1,255	3,390	4,326	7,533	10,424
80%	11,908	10,870	1,784	218	202	198	218	545	2,393	4,051	7,331	10,318
90%	10,908	5,736	545	194	191	193	193	203	769	3,420	6,815	10,079
Long Term												
Full Simulation Period ^b	12,624	11,713	8,056	3,923	1,508	1,146	1,747	2,951	4,715	6,235	9,024	11,274
Water Year Types ^c												
Wet (32%)	11,282	9,923	3,256	836	244	281	481	953	2,268	3,536	7,094	9,531
Above Normal (16%)	13,538	11,404	7,647	1,784	432	345	727	1,769	3,947	4,484	7,437	10,553
Below Normal (13%)	12,284	11,066	9,318	4,963	1,736	1,505	2,183	3,464	5,380	5,934	8,395	11,074
Dry (24%)	13,047	13,005	11,194	6,205	2,134	1,278	2,141	3,771	5,669	8,177	10,724	12,554
Critical (15%)	14,150	14,364	12,508	8,170	4,160	3,340	4,538	6,720	8,645	11,020	12,671	13,879
Alternative 3 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-180	10	35	1,046	210	-4	-89	326	-7	-112	129	120
20%	-2	89	1,700	981	9	-25	489	123	72	9	117	33
30%	-115	129	4,226	1,268	78	13	368	399	16	143	-48	42
40%	-223	1,796	4,272	382	145	27	600	1,039	138	-193	-38	-195
50%	431	6,682	3,871	175	37	49	474	1,055	440	31	-123	456
60%	6,149	6,405	2,081	-9	-21	4	290	870	150	108	-31	4,774
70%	9,104	8,813	711	-6	-3	-2	105	512	323	87	-84	7,123
80%	8,856	8,000	919	0	0	1	3	199	519	184	132	7,301
90%	7,994	3,027	227	0	-1	1	-3	5	168	81	-94	7,140
Long Term												
Full Simulation Period ^b	3,452	3,485	1,746	378	22	4	212	437	191	55	36	2,820
Water Year Types ^c												
Wet (32%)	4,480	4,564	1,100	90	5	18	144	354	242	102	-42	6,543
Above Normal (16%)	2,491	2,935	2,039	210	-27	-7	245	658	220	85	114	4,647
Below Normal (13%)	5,373	4,442	2,660	676	33	-8	366	623	240	0	-48	-233
Dry (24%)	3,105	3,350	2,325	635	-8	0	236	420	132	-61	69	115
Critical (15%)	1,086	1,089	1,024	485	153	2	139	235	103	162	145	78

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
b Based on the 82-year simulation period.
c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.5.3. Sacramento River at Mallard Slough Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	15,237	15,536	13,384	8,515	3,874	3,239	4,335	5,680	7,198	9,928	12,185	13,719
20%	14,012	13,740	11,351	7,235	2,267	2,304	2,663	4,804	6,453	8,676	10,986	12,881
30%	13,861	13,299	8,120	5,800	1,231	978	1,835	4,016	6,001	7,995	10,513	12,500
40%	13,538	11,380	6,987	3,300	751	768	1,116	2,335	5,450	6,496	9,098	11,747
50%	12,409	6,217	6,205	2,430	463	428	742	1,724	4,356	5,735	8,265	10,544
60%	6,299	5,882	5,494	1,171	259	279	434	1,068	4,011	4,567	7,965	5,899
70%	3,172	3,144	2,322	335	218	209	313	743	3,067	4,239	7,617	3,301
80%	3,053	2,870	865	218	202	197	214	347	1,874	3,867	7,199	3,016
90%	2,914	2,710	319	194	192	192	196	198	601	3,339	6,910	2,938
Long Term												
Full Simulation Period ^b	9,172	8,228	6,310	3,544	1,486	1,142	1,535	2,514	4,524	6,181	8,988	8,454
Water Year Types^c												
Wet (32%)	6,802	5,359	2,156	746	239	263	337	600	2,026	3,434	7,135	2,988
Above Normal (16%)	11,047	8,470	5,608	1,574	459	352	482	1,112	3,727	4,399	7,324	5,906
Below Normal (13%)	6,911	6,624	6,658	4,288	1,703	1,514	1,817	2,841	5,141	5,934	8,443	11,307
Dry (24%)	9,942	9,655	8,869	5,570	2,142	1,279	1,905	3,351	5,537	8,238	10,656	12,439
Critical (15%)	13,064	13,275	11,485	7,685	4,007	3,337	4,399	6,486	8,542	10,858	12,525	13,801
Alternative 5												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	15,241	15,424	13,385	8,505	3,884	3,243	3,734	4,783	7,058	9,914	12,121	13,600
20%	14,093	13,761	11,175	7,258	2,272	2,304	2,491	4,167	6,137	8,512	11,041	12,828
30%	13,846	13,301	8,136	5,800	1,229	993	1,697	3,484	5,932	7,935	10,490	12,552
40%	13,449	11,350	6,985	3,299	748	768	1,031	2,209	5,214	6,470	9,070	11,707
50%	12,255	6,186	6,218	2,436	463	439	746	1,628	4,380	5,741	8,281	10,422
60%	6,301	5,816	5,492	1,168	258	278	439	1,106	4,009	4,587	7,916	5,949
70%	3,171	3,143	2,289	333	218	208	313	703	3,037	4,240	7,575	3,297
80%	3,061	2,871	872	218	202	197	216	331	1,857	3,882	7,148	3,023
90%	2,909	2,711	331	194	192	192	196	198	602	3,351	6,916	2,949
Long Term												
Full Simulation Period ^b	9,163	8,199	6,309	3,570	1,508	1,146	1,397	2,262	4,383	6,124	8,938	8,441
Water Year Types^c												
Wet (32%)	6,800	5,380	2,158	745	239	263	333	570	2,015	3,396	7,077	2,987
Above Normal (16%)	11,030	8,291	5,547	1,571	459	353	480	1,080	3,707	4,398	7,322	5,925
Below Normal (13%)	6,923	6,630	6,665	4,294	1,702	1,513	1,653	2,579	5,058	5,909	8,397	11,232
Dry (24%)	9,931	9,633	8,899	5,601	2,152	1,282	1,657	2,968	5,362	8,190	10,613	12,432
Critical (15%)	13,035	13,254	11,487	7,809	4,145	3,357	4,027	5,741	7,997	10,656	12,425	13,773
Alternative 5 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4	-112	1	-10	10	4	-602	-896	-140	-14	-64	-119
20%	82	21	-176	23	5	0	-172	-637	-315	-164	55	-53
30%	-14	2	16	0	-3	15	-138	-532	-69	-60	-23	51
40%	-89	-31	-3	-1	-3	0	-85	-126	-236	-27	-29	-40
50%	-154	-31	14	6	0	11	4	-96	24	6	16	-122
60%	2	-66	-2	-3	-1	-1	6	38	-2	20	-50	49
70%	-1	0	-33	-3	0	0	0	-40	-30	1	-43	-4
80%	8	1	7	-1	0	0	1	-16	-17	15	-50	7
90%	-5	2	12	0	0	0	0	0	1	13	6	10
Long Term												
Full Simulation Period ^b	-9	-29	0	26	22	4	-138	-252	-140	-57	-50	-13
Water Year Types^c												
Wet (32%)	-2	21	2	-1	0	0	-3	-29	-12	-38	-59	-1
Above Normal (16%)	-17	-179	-60	-2	0	0	-2	-32	-20	-1	-2	19
Below Normal (13%)	12	6	6	7	-1	-1	-163	-262	-82	-25	-46	-75
Dry (24%)	-11	-22	30	31	9	3	-248	-383	-175	-48	-43	-7
Critical (15%)	-29	-21	2	124	139	20	-372	-744	-545	-202	-100	-28

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.5.4. Sacramento River at Mallard Slough Salinity, Monthly EC

Second Basis of Comparison												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	15,090	15,314	13,389	10,837	5,727	4,332	4,576	5,857	7,222	9,867	12,466	13,714
20%	13,893	13,680	13,246	9,520	3,298	2,537	3,316	4,889	6,259	8,724	11,178	12,976
30%	13,545	13,389	12,331	7,985	2,148	1,232	2,636	4,475	5,630	8,118	10,782	12,513
40%	13,332	13,129	11,675	5,376	1,062	1,012	1,856	3,141	4,780	6,416	9,510	11,868
50%	12,917	12,752	10,145	3,654	654	562	1,293	2,552	4,332	5,844	8,488	11,234
60%	12,563	12,217	7,519	1,717	333	276	754	1,751	3,874	4,942	7,987	10,807
70%	12,314	11,977	4,052	393	217	210	379	1,247	3,159	4,624	7,792	10,651
80%	11,890	10,939	1,860	234	203	199	224	444	2,199	3,992	7,567	10,415
90%	10,671	6,016	549	195	191	194	195	201	640	3,386	7,097	10,072
Long Term												
Full Simulation Period ^b	12,558	11,604	8,216	4,552	1,923	1,359	1,857	2,909	4,430	6,308	9,200	11,360
Water Year Types^c												
Wet (32%)	11,338	9,856	3,407	1,042	262	275	480	866	1,996	3,614	7,282	9,584
Above Normal (16%)	13,300	11,306	8,006	2,349	621	377	770	1,688	3,550	4,561	7,621	10,626
Below Normal (13%)	12,105	10,844	9,298	6,338	2,544	1,773	2,346	3,389	4,596	6,053	8,887	11,489
Dry (24%)	13,074	12,921	11,277	7,247	2,789	1,594	2,328	3,716	5,491	8,252	10,831	12,584
Critical (15%)	13,952	14,214	12,773	8,412	4,920	3,998	4,785	6,873	8,734	11,031	12,635	13,844

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	15,237	15,536	13,384	8,515	3,874	3,239	4,335	5,680	7,198	9,928	12,185	13,719
20%	14,012	13,740	11,351	7,235	2,267	2,304	2,663	4,804	6,453	8,676	10,986	12,881
30%	13,861	13,299	8,120	5,800	1,231	978	1,835	4,016	6,001	7,995	10,513	12,500
40%	13,538	11,380	6,987	3,300	751	768	1,116	2,335	5,450	6,496	9,098	11,747
50%	12,409	6,217	6,205	2,430	463	428	742	1,724	4,356	5,735	8,265	10,544
60%	6,299	5,882	5,494	1,171	259	279	434	1,068	4,011	4,567	7,965	5,899
70%	3,172	3,144	2,322	335	218	209	313	743	3,067	4,239	7,617	3,301
80%	3,053	2,870	865	218	202	197	214	347	1,874	3,867	7,199	3,016
90%	2,914	2,710	319	194	192	192	196	198	601	3,339	6,910	2,938
Long Term												
Full Simulation Period ^b	9,172	8,228	6,310	3,544	1,486	1,142	1,535	2,514	4,524	6,181	8,988	8,454
Water Year Types^c												
Wet (32%)	6,802	5,359	2,156	746	239	263	337	600	2,026	3,434	7,135	2,988
Above Normal (16%)	11,047	8,470	5,608	1,574	459	352	482	1,112	3,727	4,399	7,324	5,906
Below Normal (13%)	6,911	6,624	6,658	4,288	1,703	1,514	1,817	2,841	5,141	5,934	8,443	11,307
Dry (24%)	9,942	9,655	8,869	5,570	2,142	1,279	1,905	3,351	5,537	8,238	10,656	12,439
Critical (15%)	13,064	13,275	11,485	7,685	4,007	3,337	4,399	6,486	8,542	10,858	12,525	13,801

No Action Alternative minus Second Basis of Comparison												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	147	222	-6	-2,321	-1,852	-1,093	-240	-177	-24	61	-281	5
20%	119	60	-1,895	-2,285	-1,031	-233	-653	-84	193	-48	-192	-95
30%	315	-90	-4,211	-2,185	-916	-254	-801	-459	372	-122	-269	-12
40%	206	-1,749	-4,688	-2,076	-311	-244	-740	-806	669	80	-411	-121
50%	-508	-6,536	-3,940	-1,224	-191	-134	-552	-827	24	-110	-223	-690
60%	-6,263	-6,335	-2,025	-546	-74	3	-321	-683	137	-376	-21	-4,908
70%	-9,142	-8,834	-1,731	-58	0	-1	-66	-504	-92	-385	-175	-7,350
80%	-8,837	-8,069	-995	-16	-1	-2	-9	-97	-325	-125	-369	-7,399
90%	-7,757	-3,307	-230	-1	1	-2	1	-3	-39	-48	-188	-7,134
Long Term												
Full Simulation Period ^b	-3,386	-3,376	-1,907	-1,007	-437	-216	-322	-395	94	-127	-212	-2,906
Water Year Types^c												
Wet (32%)	-4,535	-4,497	-1,251	-296	-23	-12	-144	-266	31	-180	-147	-6,596
Above Normal (16%)	-2,253	-2,837	-2,398	-776	-162	-24	-287	-576	177	-161	-297	-4,720
Below Normal (13%)	-5,194	-4,220	-2,639	-2,050	-841	-259	-530	-548	545	-119	-444	-182
Dry (24%)	-3,132	-3,266	-2,408	-1,677	-647	-316	-423	-365	46	-15	-176	-145
Critical (15%)	-888	-939	-1,288	-728	-914	-661	-386	-387	-192	-173	-110	-44

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.5.5. Sacramento River at Mallard Slough Salinity, Monthly EC

Second Basis of Comparison		Monthly EC (UMHOS/CM)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
10%	15,090	15,314	13,389	10,837	5,727	4,332	4,576	5,857	7,222	9,867	12,466	13,714	
20%	13,893	13,680	13,246	9,520	3,298	2,537	3,316	4,889	6,259	8,724	11,178	12,976	
30%	13,545	13,389	12,331	7,985	2,148	1,232	2,636	4,475	5,630	8,118	10,782	12,513	
40%	13,332	13,129	11,675	5,376	1,062	1,012	1,856	3,141	4,780	6,416	9,510	11,868	
50%	12,917	12,752	10,145	3,654	654	562	1,293	2,552	4,332	5,844	8,488	11,234	
60%	12,563	12,217	7,519	1,717	333	276	754	1,751	3,874	4,942	7,987	10,807	
70%	12,314	11,977	4,052	393	217	210	379	1,247	3,159	4,624	7,792	10,651	
80%	11,890	10,939	1,860	234	203	199	224	444	2,199	3,992	7,567	10,415	
90%	10,671	6,016	549	195	191	194	195	201	640	3,386	7,097	10,072	
Long Term													
Full Simulation Period ^b	12,558	11,604	8,216	4,552	1,923	1,359	1,857	2,909	4,430	6,308	9,200	11,360	
Water Year Types ^c													
Wet (32%)	11,338	9,856	3,407	1,042	262	275	480	866	1,996	3,614	7,282	9,584	
Above Normal (16%)	13,300	11,306	8,006	2,349	621	377	770	1,688	3,550	4,561	7,621	10,626	
Below Normal (13%)	12,105	10,844	9,298	6,338	2,544	1,773	2,346	3,389	4,596	6,053	8,887	11,489	
Dry (24%)	13,074	12,921	11,277	7,247	2,789	1,594	2,328	3,716	5,491	8,252	10,831	12,584	
Critical (15%)	13,952	14,214	12,773	8,412	4,920	3,998	4,785	6,873	8,734	11,031	12,635	13,844	

Alternative 3

Alternative 3		Monthly EC (UMHOS/CM)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
10%	15,057	15,546	13,418	9,561	4,084	3,235	4,246	6,006	7,191	9,816	12,314	13,839	
20%	14,010	13,829	13,051	8,216	2,276	2,279	3,152	4,927	6,524	8,685	11,103	12,914	
30%	13,745	13,428	12,346	7,068	1,309	990	2,203	4,416	6,017	8,138	10,465	12,542	
40%	13,315	13,176	11,259	3,682	896	795	1,716	3,375	5,588	6,304	9,061	11,552	
50%	12,840	12,899	10,075	2,606	500	477	1,215	2,780	4,796	5,766	8,142	11,000	
60%	12,448	12,287	7,575	1,162	238	283	724	1,939	4,161	4,674	7,935	10,673	
70%	12,276	11,957	3,033	329	215	207	418	1,255	3,390	4,326	7,533	10,424	
80%	11,908	10,870	1,784	218	202	198	218	545	2,393	4,051	7,331	10,318	
90%	10,908	5,736	545	194	191	193	193	203	769	3,420	6,815	10,079	
Long Term													
Full Simulation Period ^b	12,624	11,713	8,056	3,923	1,508	1,146	1,747	2,951	4,715	6,235	9,024	11,274	
Water Year Types ^c													
Wet (32%)	11,282	9,923	3,256	836	244	281	481	953	2,268	3,536	7,094	9,531	
Above Normal (16%)	13,538	11,404	7,647	1,784	432	345	727	1,769	3,947	4,484	7,437	10,553	
Below Normal (13%)	12,284	11,066	9,318	4,963	1,736	1,505	2,183	3,464	5,380	5,934	8,395	11,074	
Dry (24%)	13,047	13,005	11,194	6,205	2,134	1,278	2,141	3,771	5,669	8,177	10,724	12,554	
Critical (15%)	14,150	14,364	12,508	8,170	4,160	3,340	4,538	6,720	8,645	11,020	12,671	13,879	

Alternative 3 minus Second Basis of Comparison

Alternative 3 minus Second Basis of Comparison		Monthly EC (UMHOS/CM)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
10%	-33	232	29	-1,276	-1,643	-1,097	-329	149	-31	-51	-152	125	
20%	117	149	-195	-1,304	-1,022	-258	-164	38	265	-39	-75	-62	
30%	200	39	15	-917	-839	-241	-433	-59	388	20	-317	29	
40%	-17	47	-416	-1,694	-165	-217	-140	234	807	-112	-449	-316	
50%	-77	147	-70	-1,048	-154	-85	-78	228	464	-78	-346	-234	
60%	-115	70	57	-555	-95	7	-31	188	287	-268	-52	-134	
70%	-39	-21	-1,019	-64	-3	-3	39	8	232	-298	-259	-227	
80%	18	-69	-76	-16	-1	-1	-6	102	194	59	-237	-97	
90%	237	-280	-4	-1	0	-1	-1	2	130	34	-282	6	
Long Term													
Full Simulation Period ^b	66	109	-161	-629	-415	-212	-110	42	285	-73	-176	-86	
Water Year Types ^c													
Wet (32%)	-56	67	-151	-206	-18	6	0	87	273	-78	-188	-53	
Above Normal (16%)	238	98	-359	-565	-189	-31	-43	82	398	-77	-183	-73	
Below Normal (13%)	179	222	20	-1,374	-808	-268	-163	75	785	-119	-492	-415	
Dry (24%)	-27	83	-83	-1,042	-655	-316	-187	55	178	-76	-107	-30	
Critical (15%)	198	150	-264	-243	-761	-658	-247	-153	-89	-11	35	35	

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.5.6. Sacramento River at Mallard Slough Salinity, Monthly EC

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance^a												
10%	15,090	15,314	13,389	10,837	5,727	4,332	4,576	5,857	7,222	9,867	12,466	13,714
20%	13,893	13,680	13,246	9,520	3,298	2,537	3,316	4,889	6,259	8,724	11,178	12,976
30%	13,545	13,389	12,331	7,985	2,148	1,232	2,636	4,475	5,630	8,118	10,782	12,513
40%	13,332	13,129	11,675	5,376	1,062	1,012	1,856	3,141	4,780	6,416	9,510	11,868
50%	12,917	12,752	10,145	3,654	654	562	1,293	2,552	4,332	5,844	8,488	11,234
60%	12,563	12,217	7,519	1,717	333	276	754	1,751	3,874	4,942	7,987	10,807
70%	12,314	11,977	4,052	393	217	210	379	1,247	3,159	4,624	7,792	10,651
80%	11,890	10,939	1,860	234	203	199	224	444	2,199	3,992	7,567	10,415
90%	10,671	6,016	549	195	191	194	195	201	640	3,386	7,097	10,072
Long Term												
Full Simulation Period ^b	12,558	11,604	8,216	4,552	1,923	1,359	1,857	2,909	4,430	6,308	9,200	11,360
Water Year Types^c												
Wet (32%)	11,338	9,856	3,407	1,042	262	275	480	866	1,996	3,614	7,282	9,584
Above Normal (16%)	13,300	11,306	8,006	2,349	621	377	770	1,688	3,550	4,561	7,621	10,626
Below Normal (13%)	12,105	10,844	9,298	6,338	2,544	1,773	2,346	3,389	4,596	6,053	8,887	11,489
Dry (24%)	13,074	12,921	11,277	7,247	2,789	1,594	2,328	3,716	5,491	8,252	10,831	12,584
Critical (15%)	13,952	14,214	12,773	8,412	4,920	3,998	4,785	6,873	8,734	11,031	12,635	13,844

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 5												
Probability of Exceedance^a												
10%	15,241	15,424	13,385	8,505	3,884	3,243	3,734	4,783	7,058	9,914	12,121	13,600
20%	14,093	13,761	11,175	7,258	2,272	2,304	2,491	4,167	6,137	8,512	11,041	12,828
30%	13,846	13,301	8,136	5,800	1,229	993	1,697	3,484	5,932	7,935	10,490	12,552
40%	13,449	11,350	6,985	3,299	748	768	1,031	2,209	5,214	6,470	9,070	11,707
50%	12,255	6,186	6,218	2,436	463	439	746	1,628	4,380	5,741	8,281	10,422
60%	6,301	5,816	5,492	1,168	258	278	439	1,106	4,009	4,587	7,916	5,949
70%	3,171	3,143	2,289	333	218	208	313	703	3,037	4,240	7,575	3,297
80%	3,061	2,871	872	218	202	197	216	331	1,857	3,882	7,148	3,023
90%	2,909	2,711	331	194	192	192	196	198	602	3,351	6,916	2,949
Long Term												
Full Simulation Period ^b	9,163	8,199	6,309	3,570	1,508	1,146	1,397	2,262	4,383	6,124	8,938	8,441
Water Year Types^c												
Wet (32%)	6,800	5,380	2,158	745	239	263	333	570	2,015	3,396	7,077	2,987
Above Normal (16%)	11,030	8,291	5,547	1,571	459	353	480	1,080	3,707	4,398	7,322	5,925
Below Normal (13%)	6,923	6,630	6,665	4,294	1,702	1,513	1,653	2,579	5,058	5,909	8,397	11,232
Dry (24%)	9,931	9,633	8,899	5,601	2,152	1,282	1,657	2,968	5,362	8,190	10,613	12,432
Critical (15%)	13,035	13,254	11,487	7,809	4,145	3,357	4,027	5,741	7,997	10,656	12,425	13,773

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 5 minus Second Basis of Comparison												
Probability of Exceedance^a												
10%	151	109	-4	-2,331	-1,843	-1,088	-842	-1,073	-164	47	-345	-114
20%	200	81	-2,070	-2,262	-1,026	-232	-825	-722	-122	-212	-137	-148
30%	301	-88	-4,195	-2,185	-919	-238	-939	-991	303	-183	-292	39
40%	117	-1,780	-4,690	-2,077	-313	-244	-824	-932	433	54	-440	-161
50%	-662	-6,566	-3,927	-1,217	-192	-123	-548	-924	48	-103	-207	-812
60%	-6,262	-6,401	-2,027	-548	-75	2	-315	-645	135	-355	-71	-4,859
70%	-9,144	-8,834	-1,763	-60	1	-1	-66	-544	-121	-383	-218	-7,354
80%	-8,829	-8,068	-988	-17	-1	-2	-8	-113	-342	-110	-419	-7,391
90%	-7,762	-3,305	-218	-1	1	-2	1	-3	-38	-35	-181	-7,124
Long Term												
Full Simulation Period ^b	-3,395	-3,405	-1,907	-981	-415	-212	-460	-647	-46	-184	-262	-2,919
Water Year Types^c												
Wet (32%)	-4,538	-4,476	-1,249	-296	-23	-12	-147	-296	19	-218	-205	-6,597
Above Normal (16%)	-2,270	-3,016	-2,459	-778	-162	-24	-290	-608	157	-163	-299	-4,701
Below Normal (13%)	-5,182	-4,215	-2,633	-2,044	-843	-260	-693	-810	462	-144	-490	-257
Dry (24%)	-3,143	-3,288	-2,378	-1,646	-637	-312	-671	-749	-130	-63	-219	-152
Critical (15%)	-917	-960	-1,286	-603	-775	-640	-758	-1,132	-738	-375	-210	-71

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c AS defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 **B.6. Sacramento River at Port Chicago Salinity**

Figure 6E.B.6.1. Sacramento River at Port Chicago Salinity, Electrical Conductivity, October

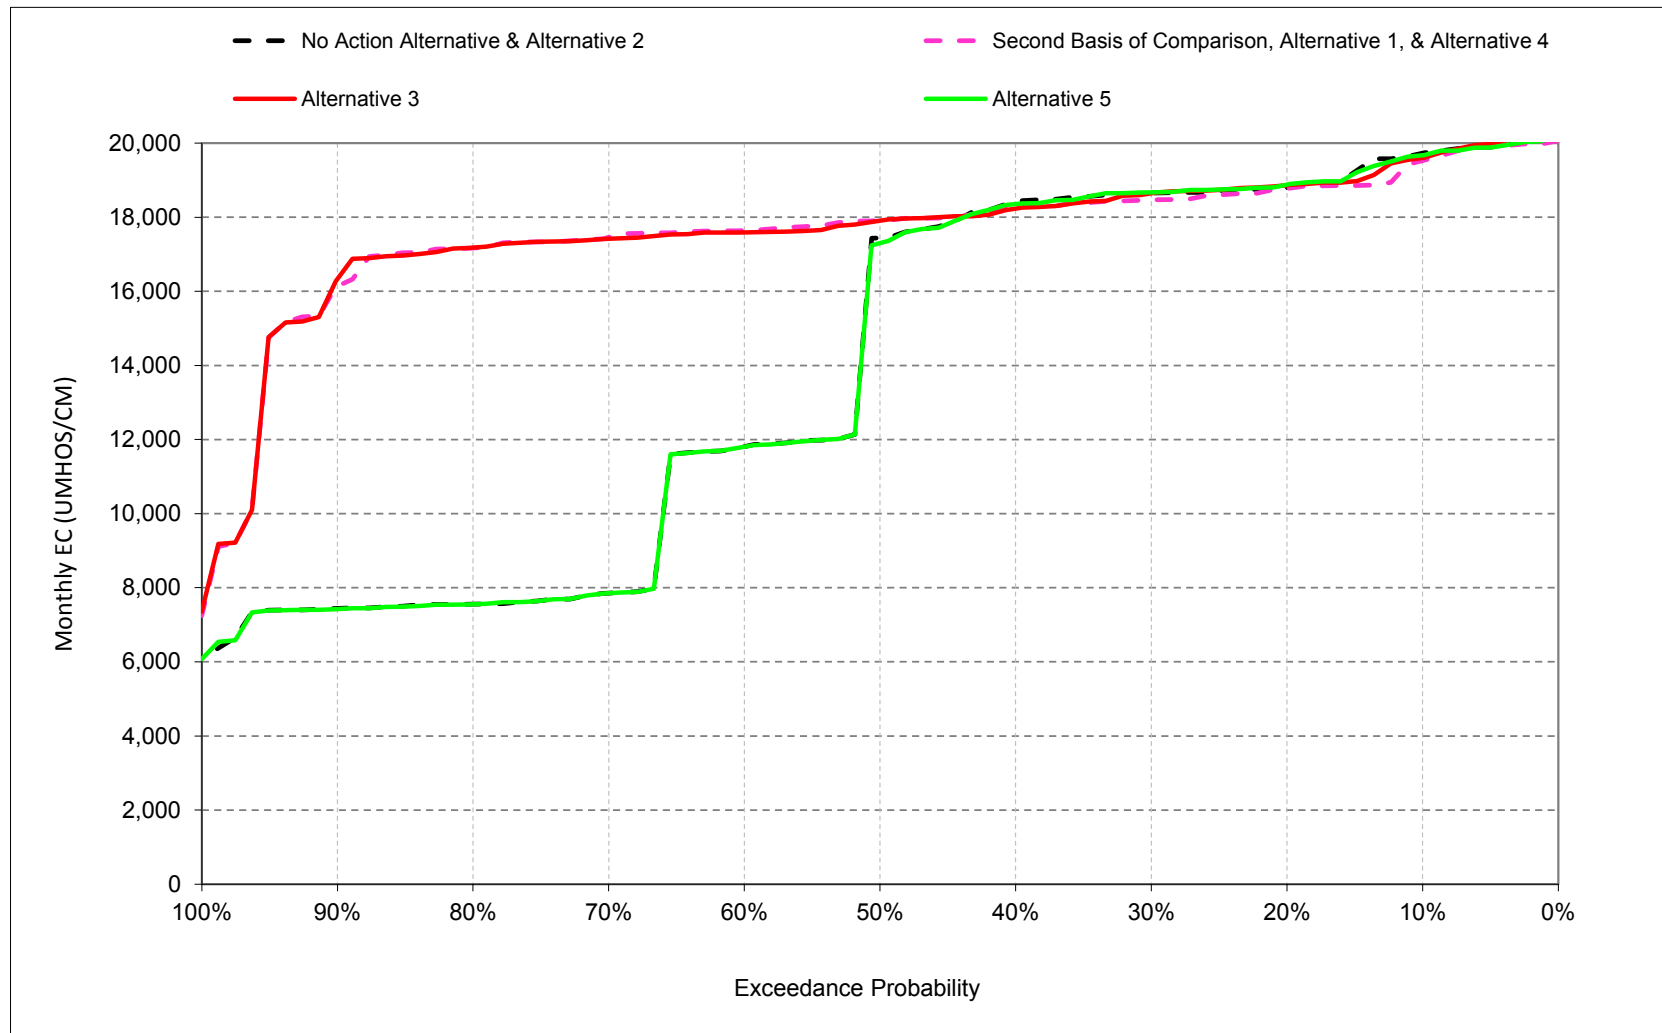


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.6.2. Sacramento River at Port Chicago Salinity, Electrical Conductivity, November

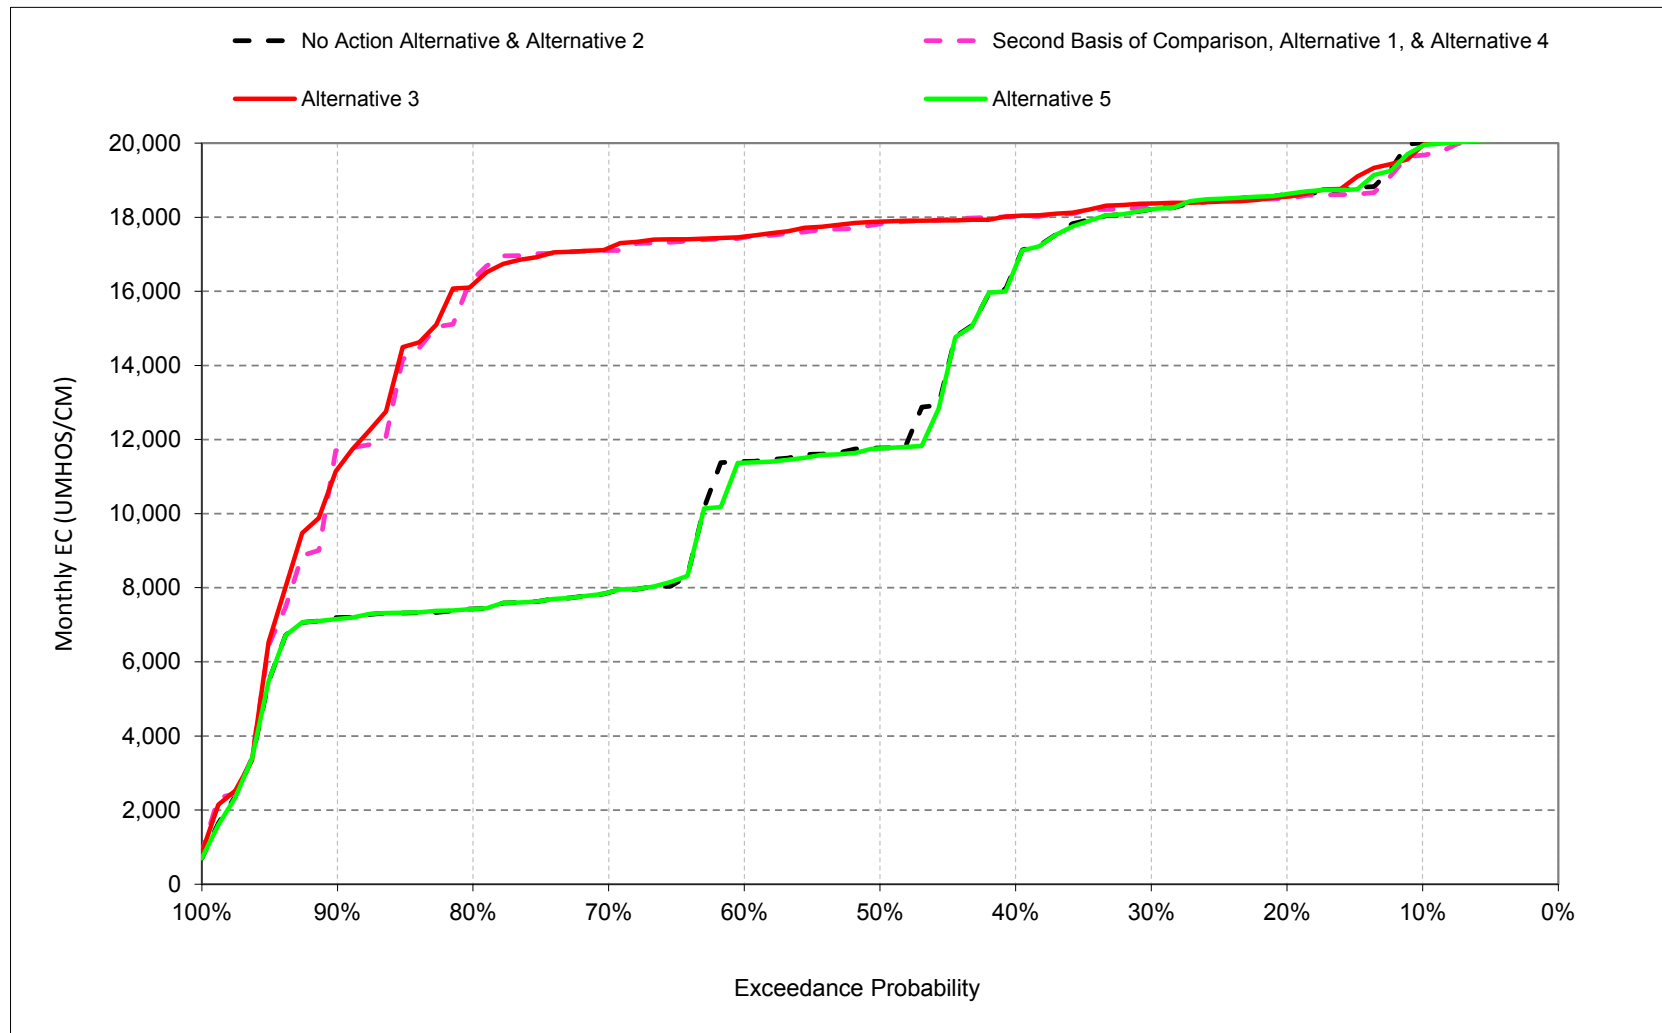


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.6.3. Sacramento River at Port Chicago Salinity, Electrical Conductivity, December

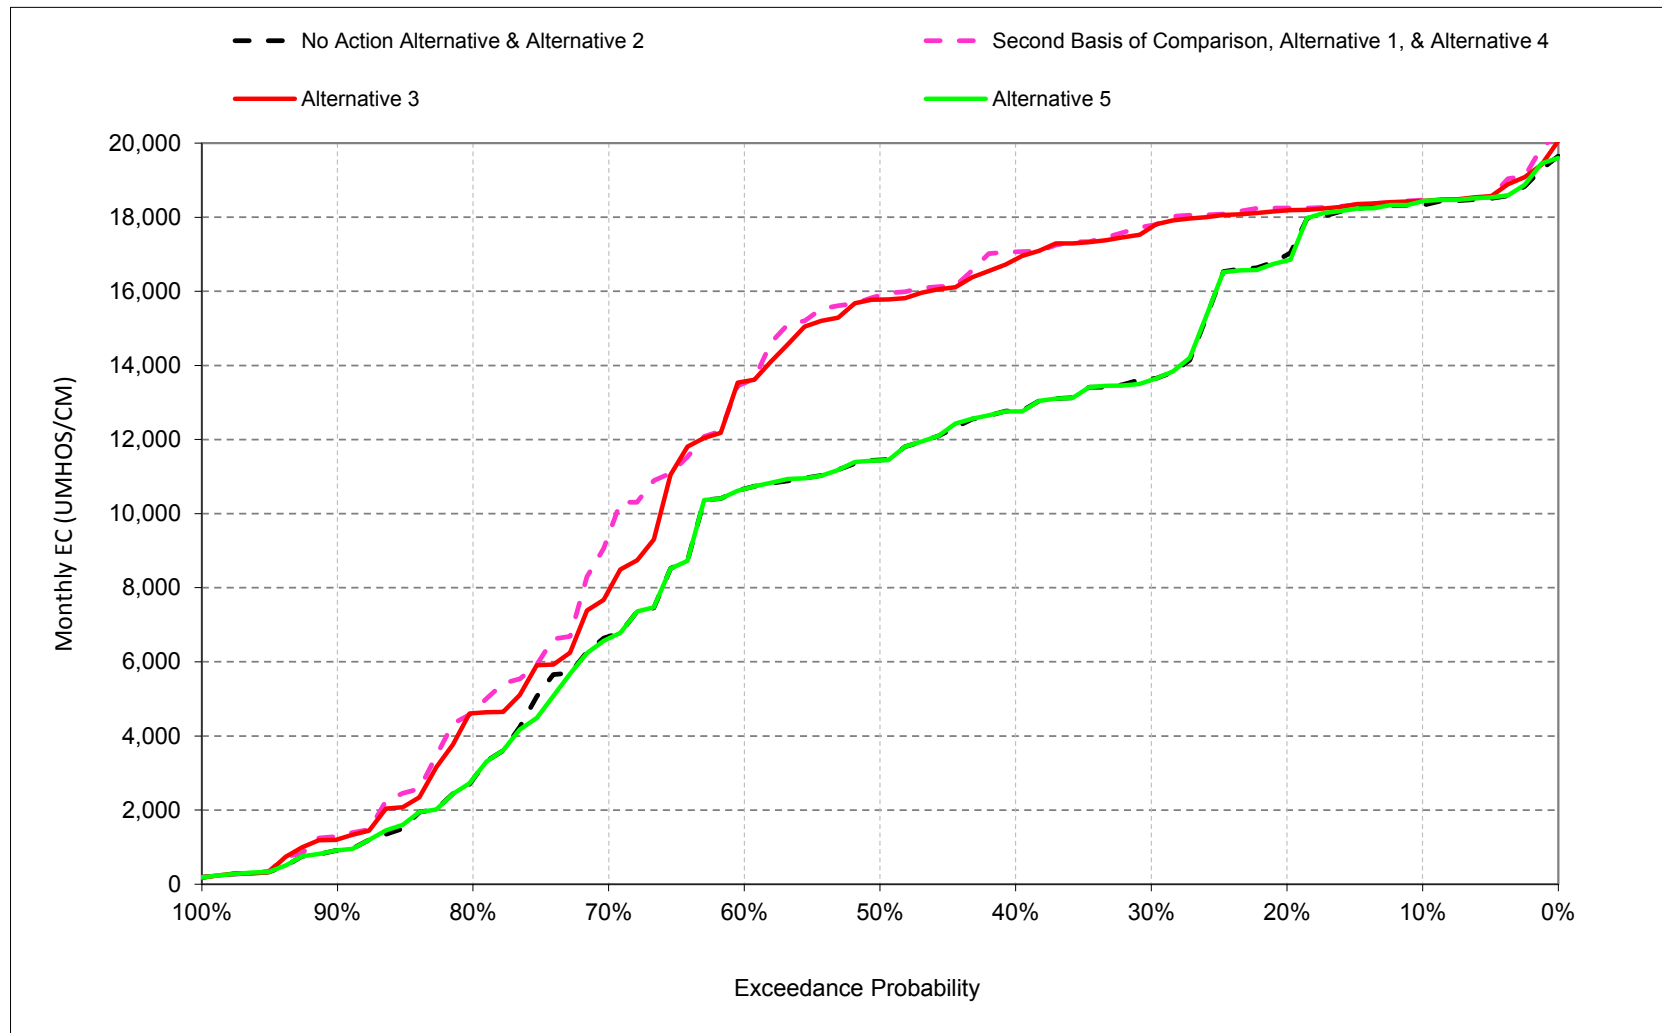


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.6.4. Sacramento River at Port Chicago Salinity, Electrical Conductivity, January

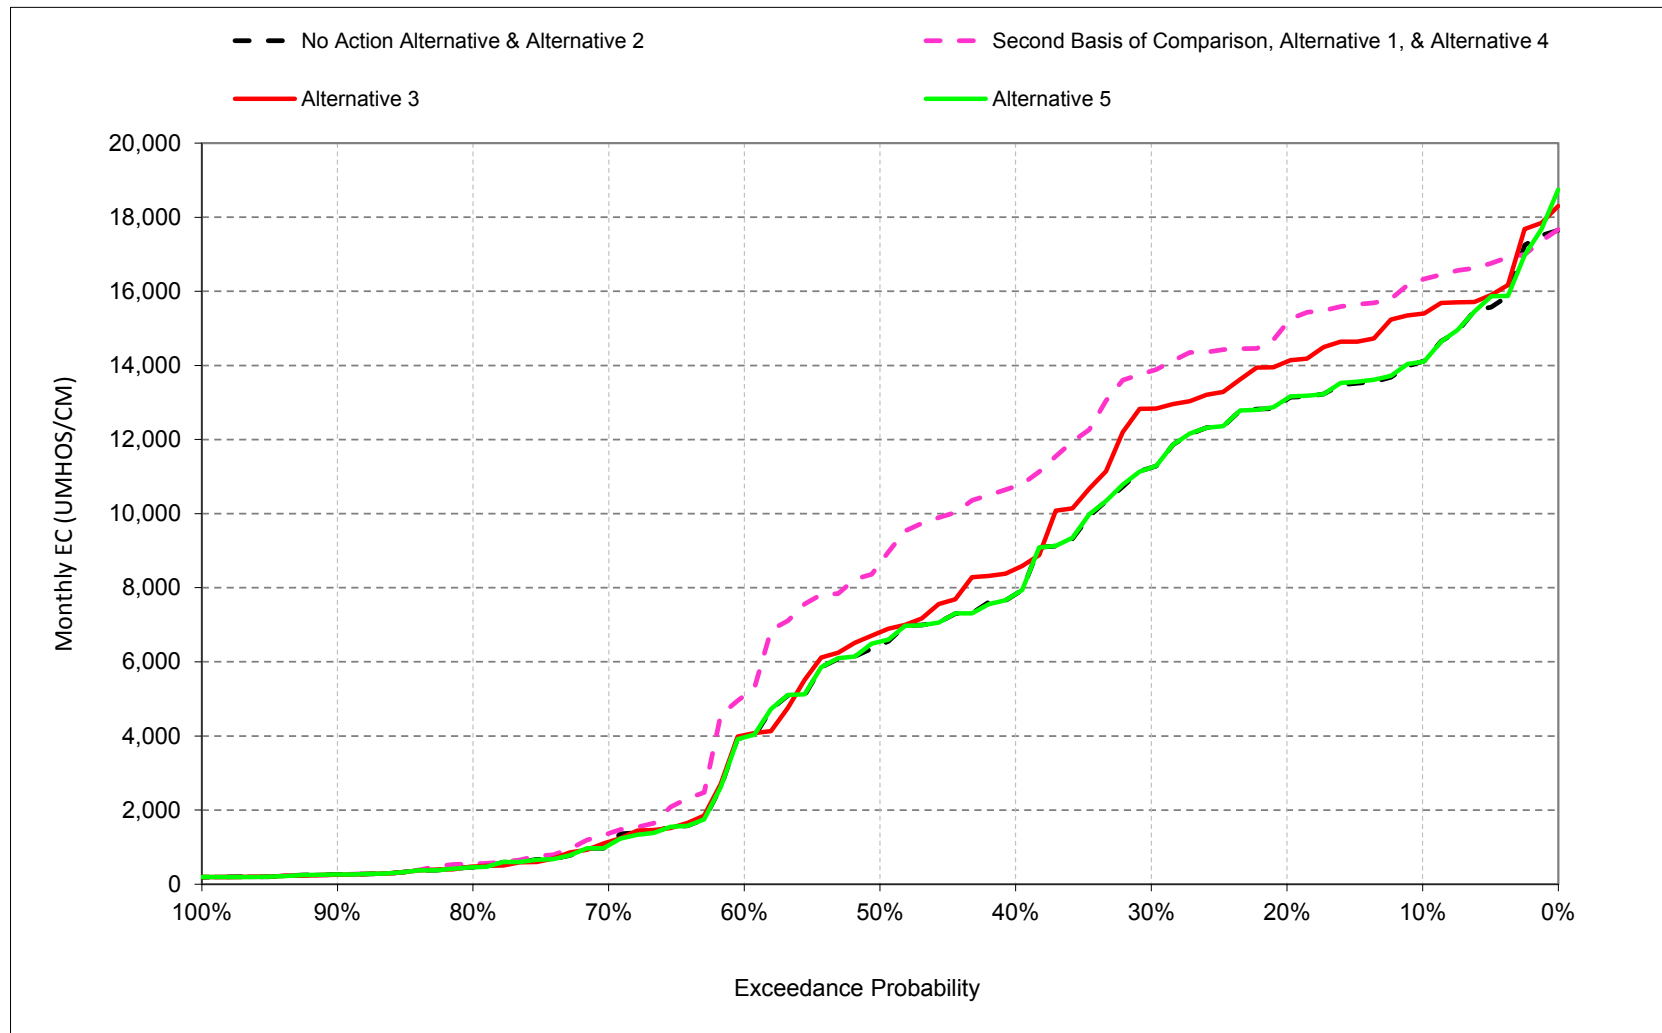


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.6.5. Sacramento River at Port Chicago Salinity, Electrical Conductivity, February

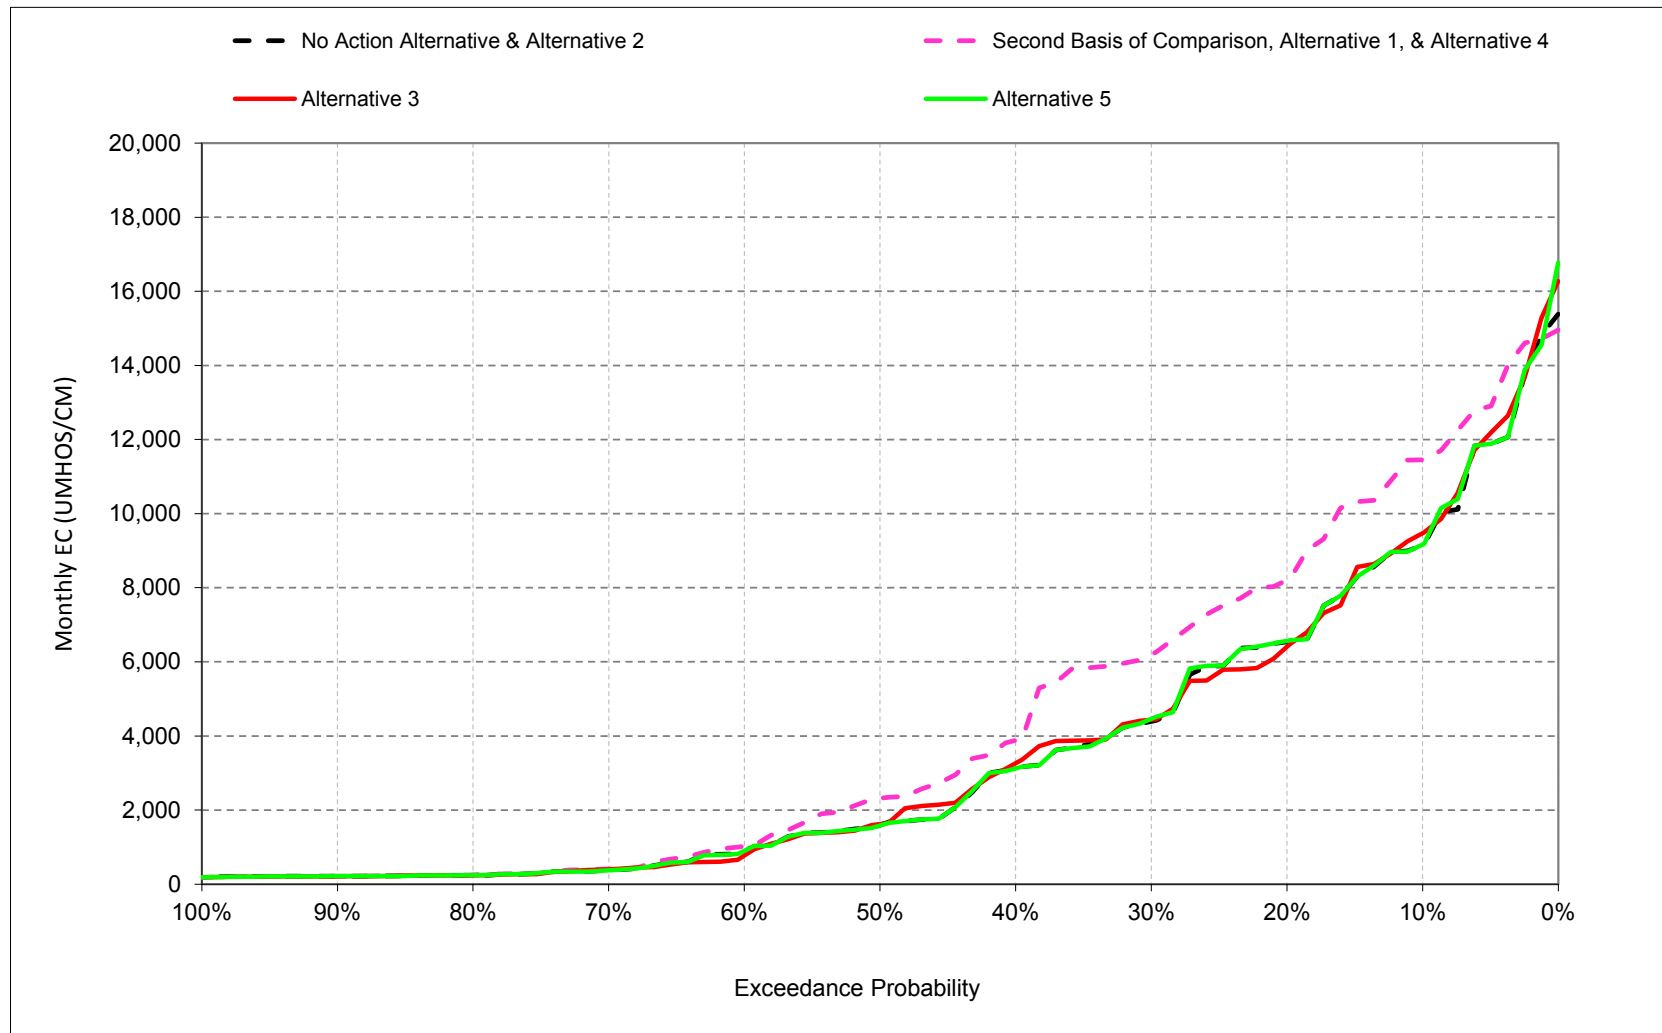


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.6.6. Sacramento River at Port Chicago Salinity, Electrical Conductivity, March

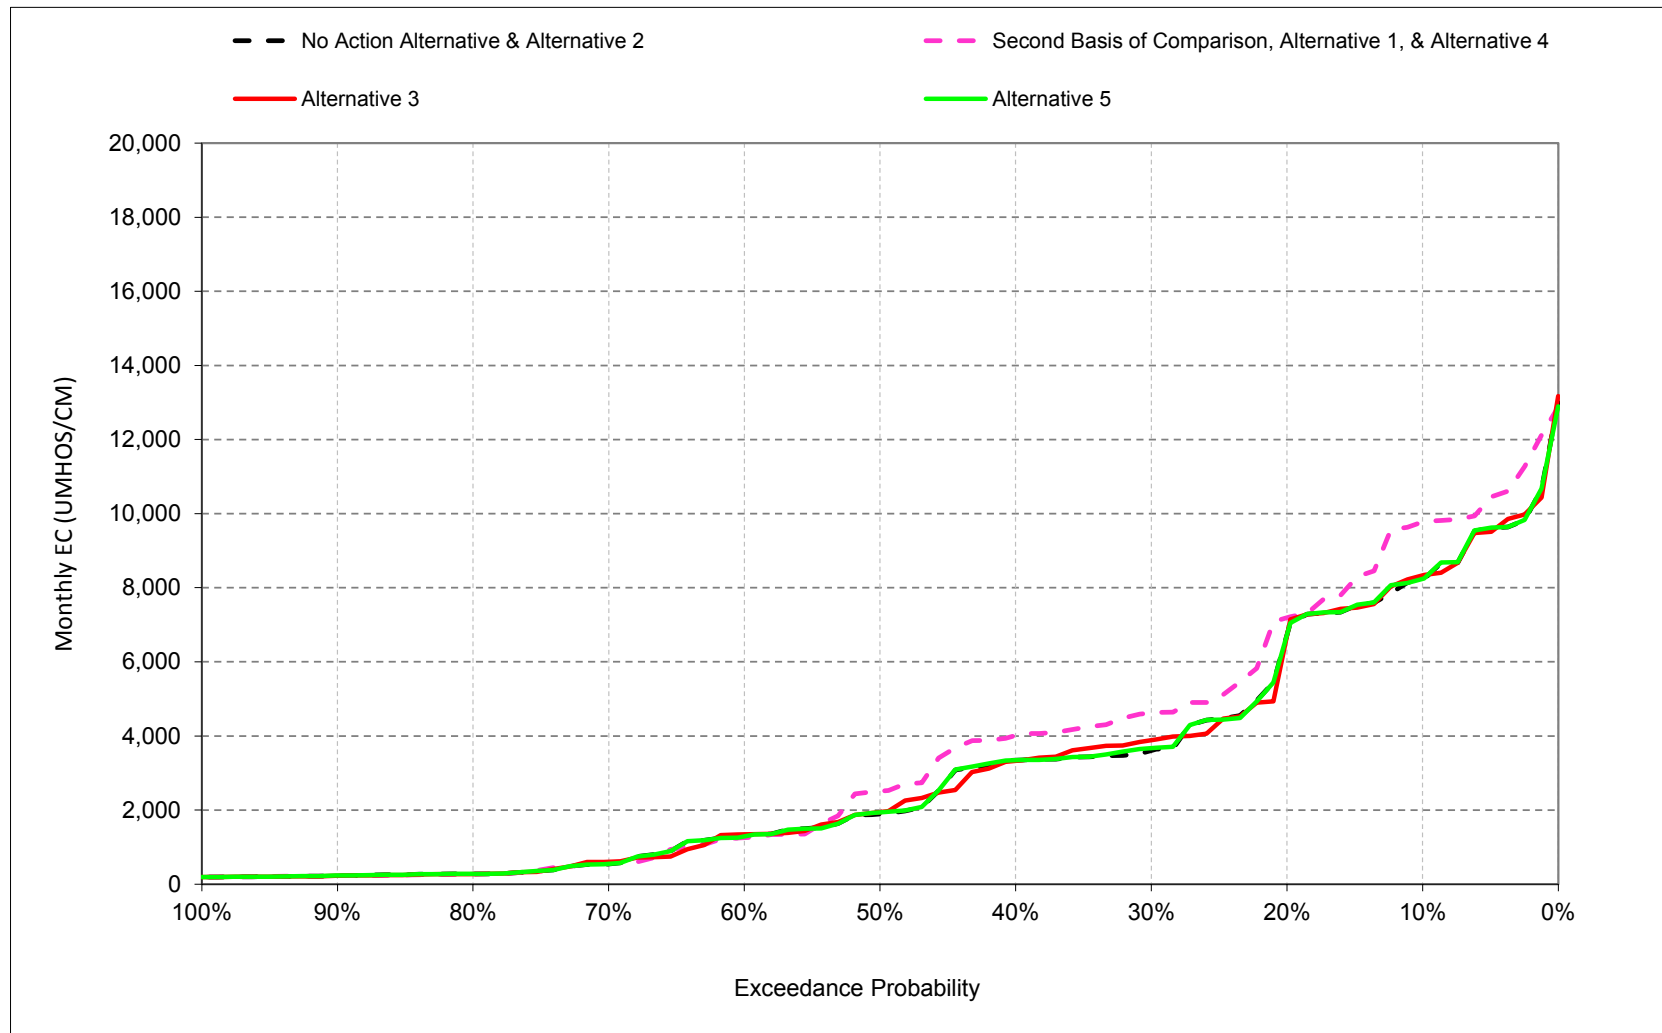


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.6.7. Sacramento River at Port Chicago Salinity, Electrical Conductivity, April

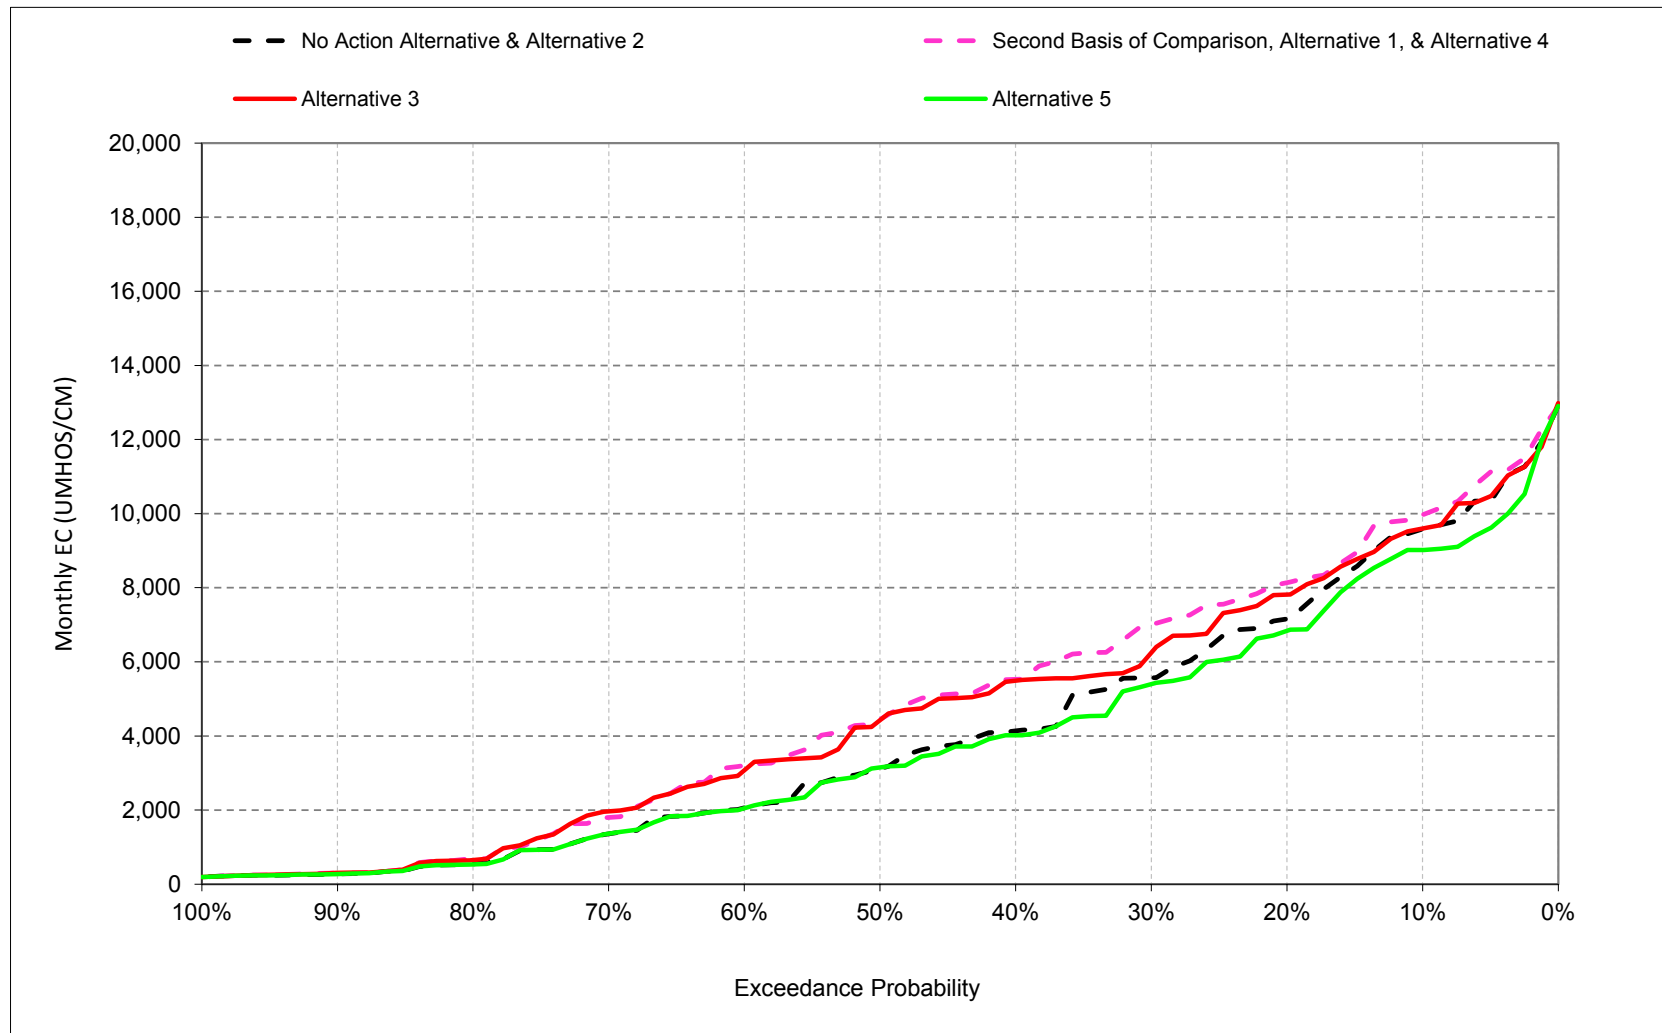


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.6.8. Sacramento River at Port Chicago Salinity, Electrical Conductivity, May

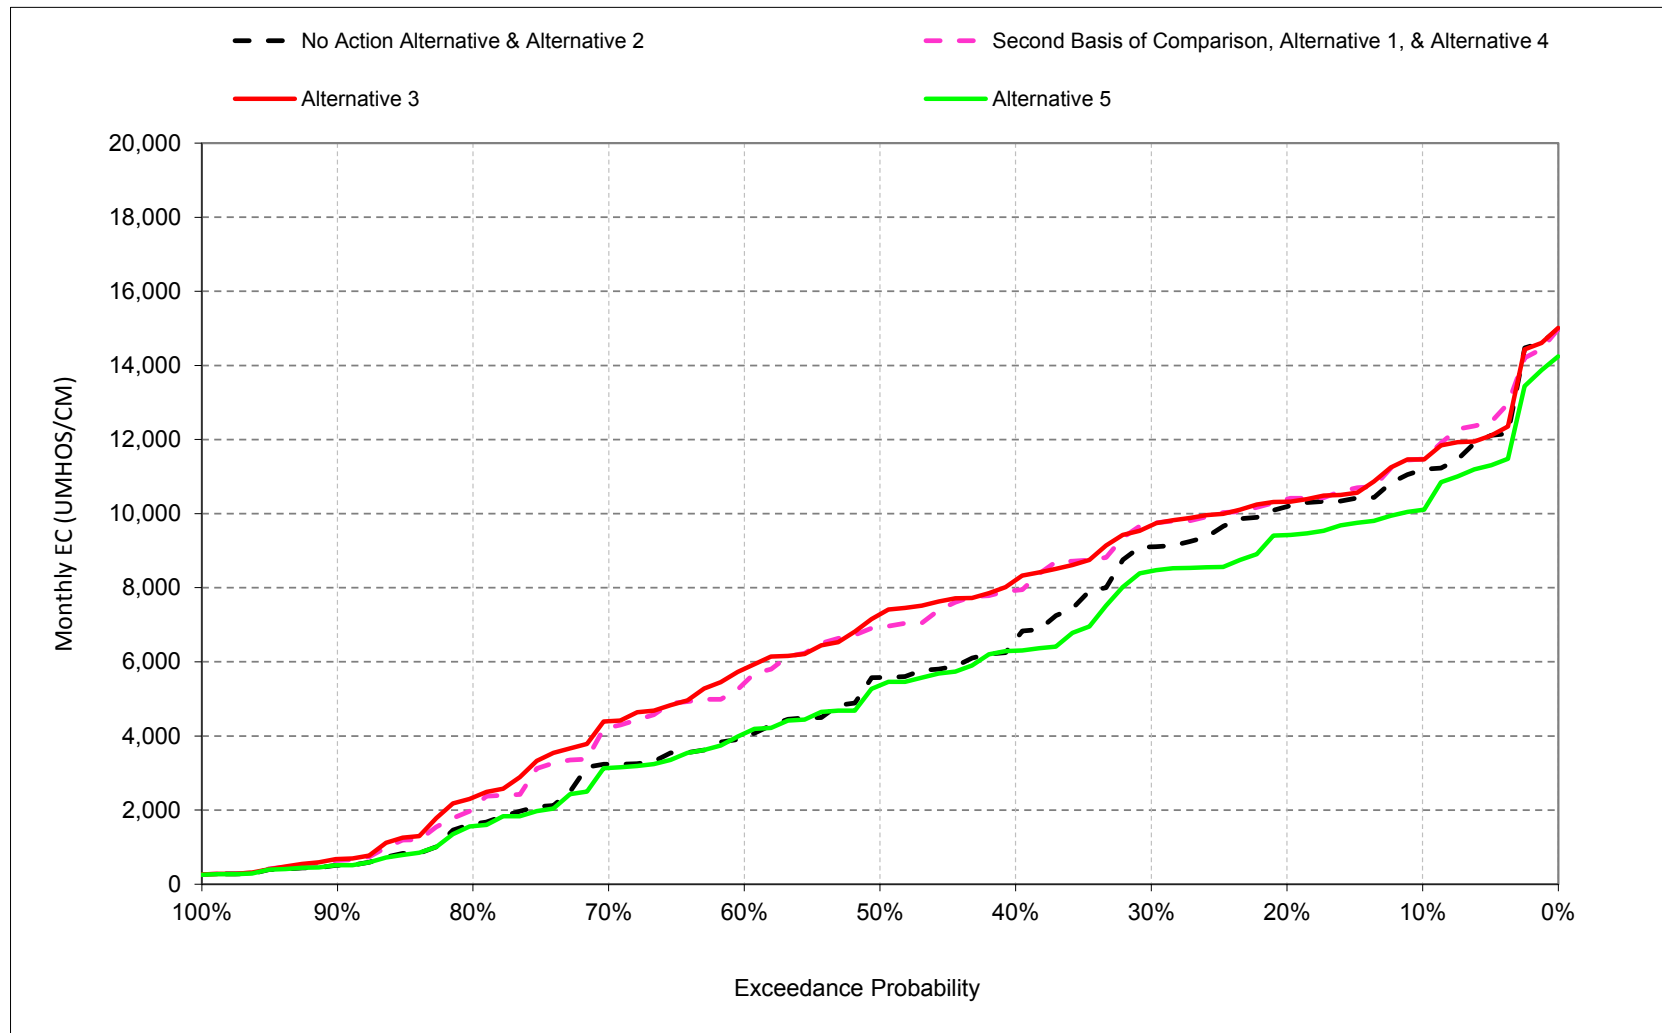


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.6.9. Sacramento River at Port Chicago Salinity, Electrical Conductivity, June

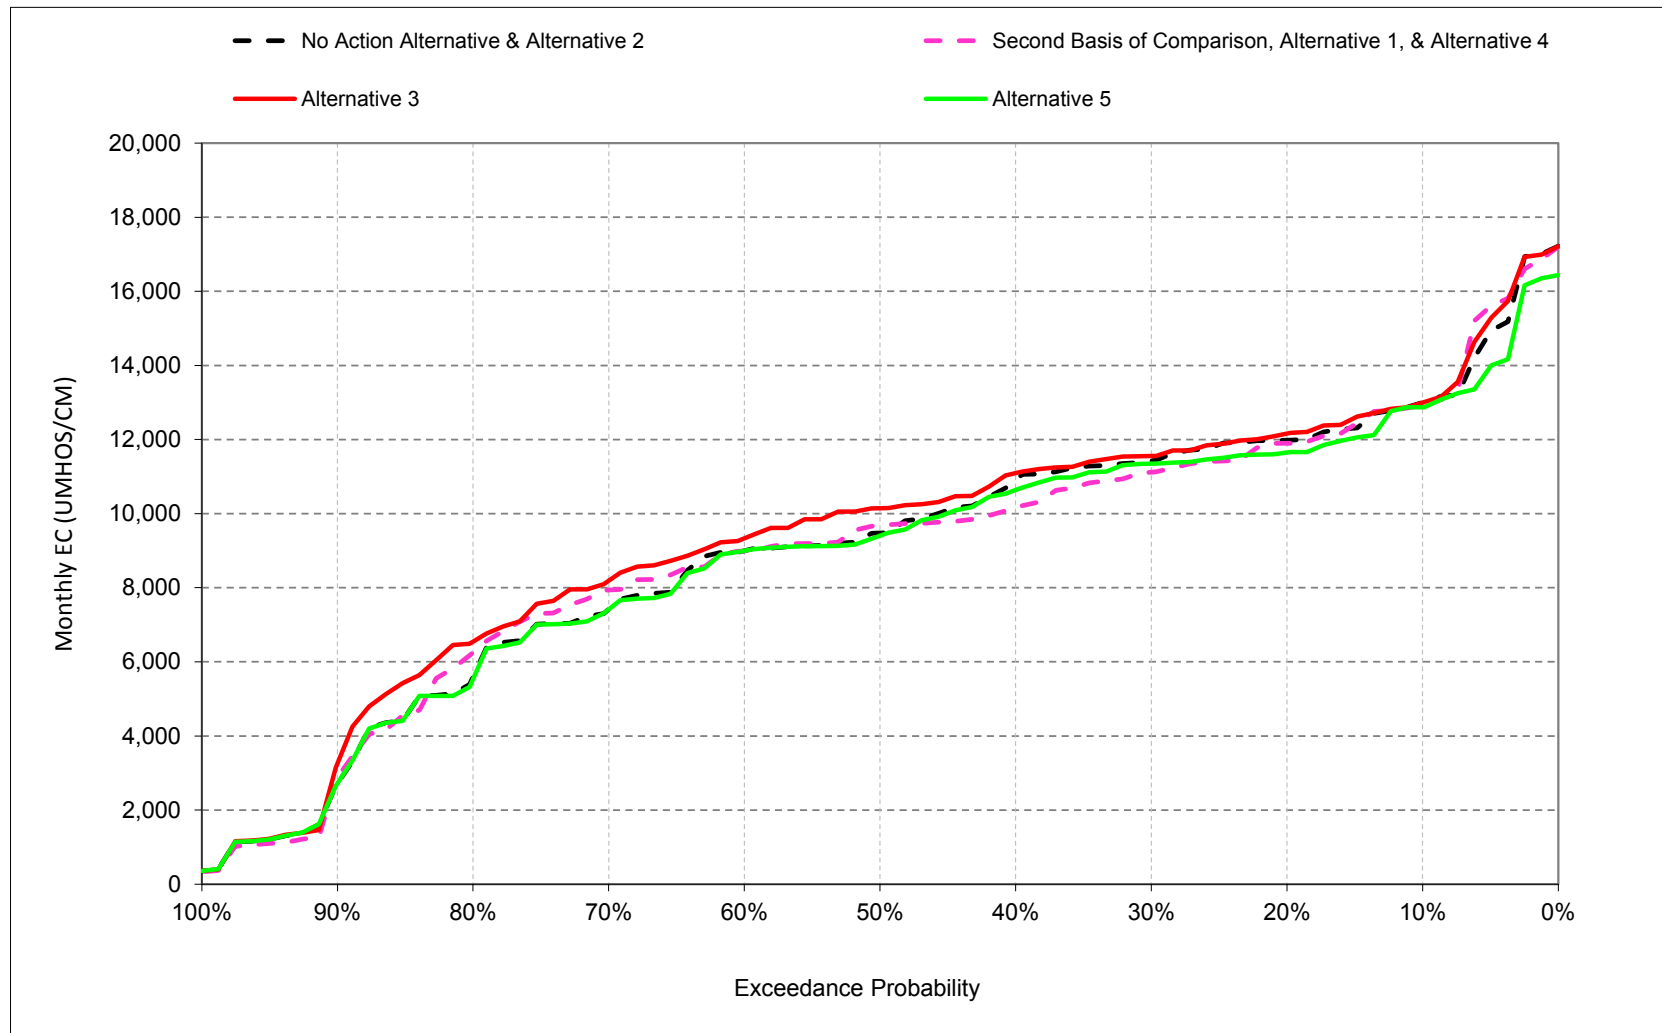


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.6.10. Sacramento River at Port Chicago Salinity, Electrical Conductivity, July

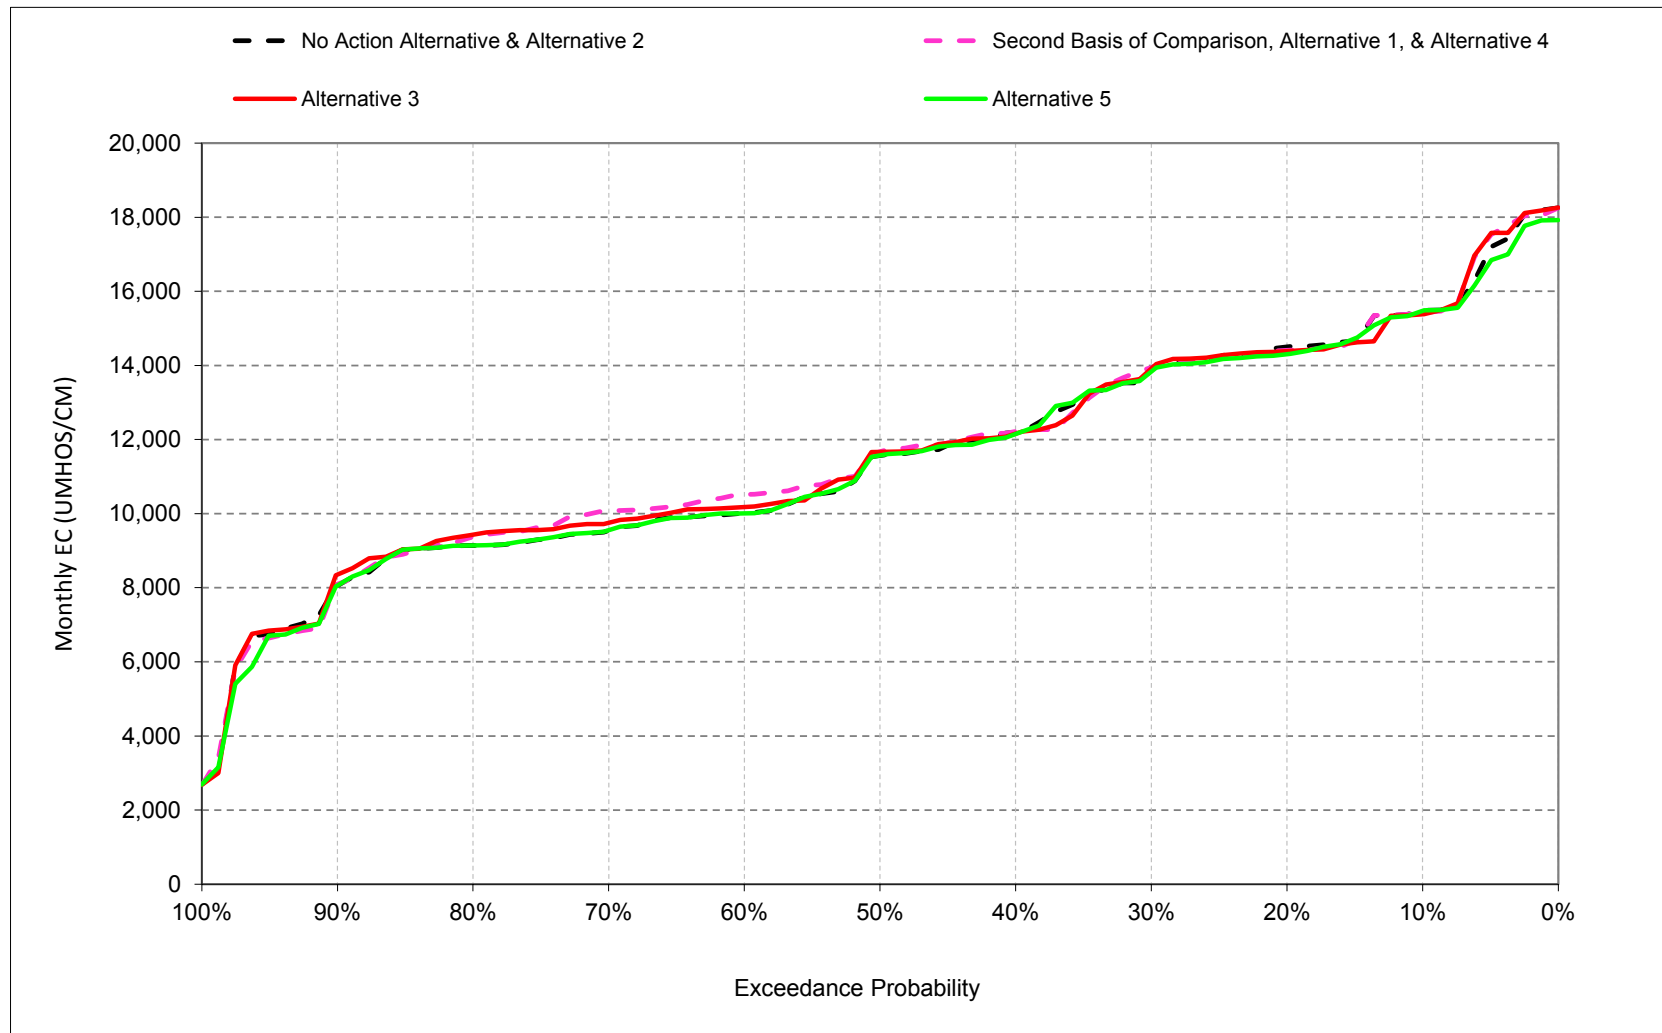


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.6.11. Sacramento River at Port Chicago Salinity, Electrical Conductivity, August

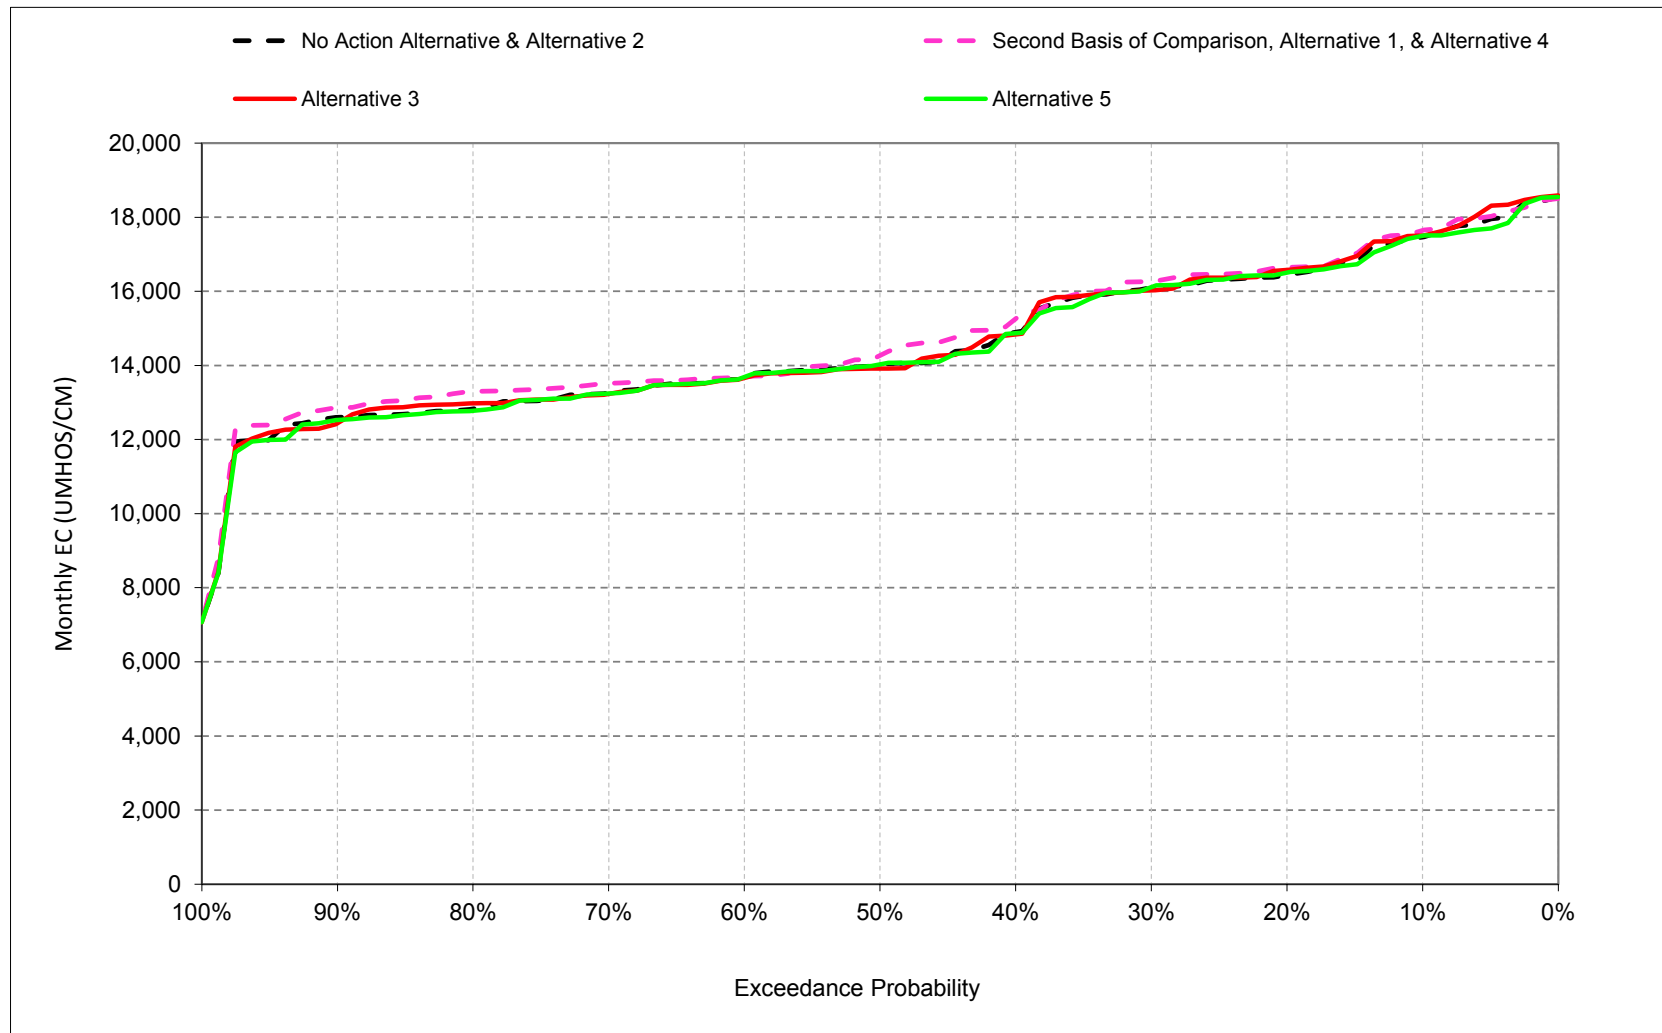

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.6.12. Sacramento River at Port Chicago Salinity, Electrical Conductivity, September

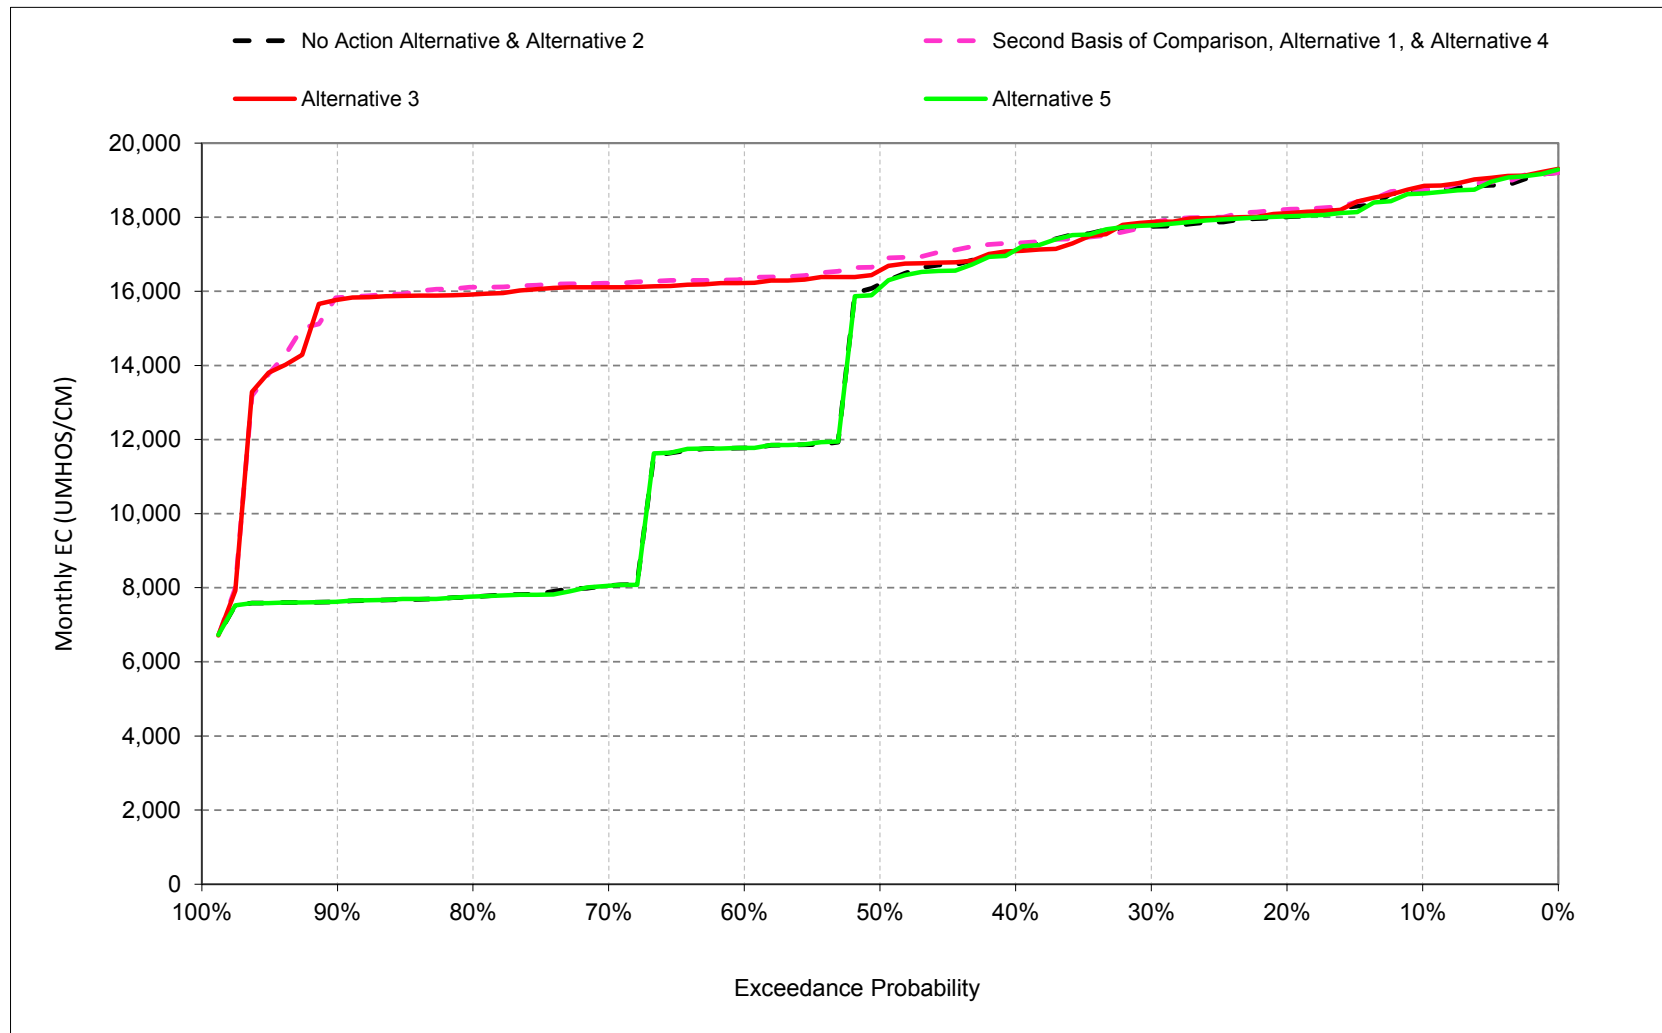

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.6.1. Sacramento River at Port Chicago Salinity, Monthly EC

No Action Alternative

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	19,730	20,008	18,334	14,105	9,148	8,232	9,583	11,184	13,000	15,476	17,464	18,731
20%	18,797	18,624	16,981	13,083	6,541	6,730	7,154	10,189	11,980	14,499	16,437	18,010
30%	18,652	18,213	13,637	11,245	4,395	3,610	5,568	9,104	11,426	13,864	16,101	17,749
40%	18,408	16,690	12,775	7,827	3,132	3,345	4,140	6,598	10,912	12,195	14,895	17,115
50%	17,441	11,772	11,450	6,456	1,597	1,896	3,119	5,575	9,479	11,568	14,019	16,190
60%	11,807	11,409	10,666	3,956	900	1,287	2,061	3,971	8,998	10,011	13,690	11,771
70%	7,856	7,870	6,682	1,088	375	547	1,360	3,234	7,421	9,544	13,261	8,081
80%	7,557	7,426	2,822	458	241	279	544	1,621	5,586	9,137	12,824	7,783
90%	7,443	7,194	915	260	215	234	276	512	2,718	8,059	12,599	7,650
Long Term												
Full Simulation Period ^b	13,932	12,941	10,458	6,752	3,502	3,167	4,064	5,836	9,049	11,543	14,564	13,647
Water Year Types^c												
Wet (32%)	11,516	9,834	4,617	1,723	522	765	1,130	1,968	5,080	8,188	12,707	7,719
Above Normal (16%)	15,746	13,225	9,834	3,584	1,351	1,149	1,906	3,817	8,398	9,863	12,993	11,773
Below Normal (13%)	11,574	11,366	11,569	8,740	4,248	4,587	5,295	7,050	10,345	11,789	14,262	16,789
Dry (24%)	14,829	14,641	14,088	10,509	5,269	3,952	5,345	7,867	10,901	13,987	16,209	17,737
Critical (15%)	17,869	17,972	16,718	12,998	8,663	7,945	9,498	11,908	14,079	16,331	17,826	18,823

Alternative 1

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	19,528	19,670	18,458	16,317	11,450	9,775	9,970	11,470	12,921	15,419	17,642	18,754
20%	18,781	18,511	18,245	15,143	8,208	7,192	8,137	10,389	11,899	14,408	16,644	18,212
30%	18,464	18,288	17,776	13,850	6,202	4,623	7,006	9,726	11,120	13,945	16,271	17,825
40%	18,276	18,012	17,064	10,736	3,882	4,015	5,531	7,929	10,159	12,220	15,257	17,306
50%	17,910	17,816	15,892	8,667	2,317	2,512	4,449	6,938	9,682	11,671	14,270	16,776
60%	17,639	17,453	13,522	5,086	1,023	1,254	3,202	5,427	8,989	10,521	13,690	16,338
70%	17,457	17,101	9,437	1,366	409	580	1,800	4,229	7,936	10,081	13,519	16,216
80%	17,169	16,331	4,663	552	250	280	684	2,048	6,252	9,363	13,299	16,111
90%	16,142	11,709	1,298	259	213	231	299	641	2,883	8,098	12,857	15,830
Long Term												
Full Simulation Period ^b	17,560	16,411	12,505	8,064	4,282	3,590	4,752	6,585	9,029	11,657	14,774	16,778
Water Year Types^c												
Wet (32%)	16,378	14,448	6,247	2,204	618	796	1,551	2,617	5,097	8,394	12,877	15,144
Above Normal (16%)	18,219	16,129	12,396	4,832	1,758	1,190	2,668	5,003	8,342	10,048	13,307	16,244
Below Normal (13%)	17,333	16,030	14,313	11,108	5,397	5,006	6,359	8,011	9,893	11,859	14,672	16,968
Dry (24%)	18,060	17,861	16,486	12,568	6,575	4,754	6,193	8,509	10,937	13,951	16,360	17,883
Critical (15%)	18,781	18,899	17,889	13,966	10,113	9,008	10,068	12,383	14,322	16,464	17,923	18,883

Alternative 1 minus No Action Alternative

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-202	-337	124	2,212	2,301	1,543	387	287	-80	-57	178	23
20%	-16	-113	1,264	2,059	1,667	462	983	200	-80	-91	207	201
30%	-187	75	4,139	2,606	1,807	1,013	1,438	622	-306	81	171	76
40%	-131	1,322	4,288	2,909	750	670	1,391	1,331	-753	24	362	191
50%	469	6,044	4,442	2,211	721	616	1,330	1,363	202	103	251	586
60%	5,832	6,045	2,855	1,130	123	-33	1,141	1,457	-10	510	0	4,567
70%	9,601	9,231	2,755	279	34	33	440	994	515	537	258	8,135
80%	9,612	8,905	1,840	94	10	2	141	427	666	226	474	8,329
90%	8,699	4,515	383	0	-2	-3	24	129	165	39	258	8,180
Long Term												
Full Simulation Period ^b	3,628	3,470	2,047	1,312	780	424	687	749	-20	114	210	3,131
Water Year Types^c												
Wet (32%)	4,862	4,614	1,630	481	96	31	421	649	17	206	170	7,425
Above Normal (16%)	2,473	2,904	2,562	1,248	407	41	762	1,186	-56	184	314	4,471
Below Normal (13%)	5,759	4,664	2,744	2,368	1,149	419	1,064	960	-453	70	410	178
Dry (24%)	3,231	3,221	2,397	2,059	1,306	801	848	642	36	-36	151	146
Critical (15%)	912	926	1,171	968	1,450	1,063	570	475	244	133	96	59

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.6.2. Sacramento River at Port Chicago Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	19,730	20,008	18,334	14,105	9,148	8,232	9,583	11,184	13,000	15,476	17,464	18,731
20%	18,797	18,624	16,981	13,083	6,541	6,730	7,154	10,189	11,980	14,499	16,437	18,010
30%	18,652	18,213	13,637	11,245	4,395	3,610	5,568	9,104	11,426	13,864	16,101	17,749
40%	18,408	16,690	12,775	7,827	3,132	3,345	4,140	6,598	10,912	12,195	14,895	17,115
50%	17,441	11,772	11,450	6,456	1,597	1,896	3,119	5,575	9,479	11,568	14,019	16,190
60%	11,807	11,409	10,666	3,956	900	1,287	2,061	3,971	8,998	10,011	13,690	11,771
70%	7,856	7,870	6,682	1,088	375	547	1,360	3,234	7,421	9,544	13,261	8,081
80%	7,557	7,426	2,822	458	241	279	544	1,621	5,586	9,137	12,824	7,783
90%	7,443	7,194	915	260	215	234	276	512	2,718	8,059	12,599	7,650
Long Term												
Full Simulation Period ^b	13,932	12,941	10,458	6,752	3,502	3,167	4,064	5,836	9,049	11,543	14,564	13,647
Water Year Types ^c												
Wet (32%)	11,516	9,834	4,617	1,723	522	765	1,130	1,968	5,080	8,188	12,707	7,719
Above Normal (16%)	15,746	13,225	9,834	3,584	1,351	1,149	1,906	3,817	8,398	9,863	12,993	11,773
Below Normal (13%)	11,574	11,366	11,569	8,740	4,248	4,587	5,295	7,050	10,345	11,789	14,262	16,789
Dry (24%)	14,829	14,641	14,088	10,509	5,269	3,952	5,345	7,867	10,901	13,987	16,209	17,737
Critical (15%)	17,869	17,972	16,718	12,998	8,663	7,945	9,498	11,908	14,079	16,331	17,826	18,823
Alternative 3												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	19,601	19,937	18,438	15,398	9,470	8,333	9,599	11,466	12,994	15,382	17,503	18,839
20%	18,862	18,556	18,182	14,100	6,405	6,703	7,815	10,318	12,163	14,385	16,580	18,110
30%	18,644	18,369	17,725	12,836	4,439	3,885	6,246	9,685	11,553	13,916	16,025	17,869
40%	18,234	18,034	16,863	8,500	3,261	3,326	5,492	8,203	11,095	12,157	14,832	17,086
50%	17,907	17,880	15,775	6,800	1,624	1,948	4,425	7,281	10,148	11,669	13,914	16,563
60%	17,591	17,474	13,564	4,021	776	1,348	3,075	5,812	9,331	10,176	13,662	16,225
70%	17,419	17,169	7,915	1,142	398	607	1,963	4,400	8,191	9,751	13,230	16,111
80%	17,176	16,182	4,611	474	241	276	654	2,337	6,542	9,430	12,977	15,940
90%	16,334	11,202	1,212	256	213	232	302	675	3,259	8,360	12,439	15,833
Long Term												
Full Simulation Period ^b	17,594	16,503	12,297	7,181	3,534	3,173	4,559	6,670	9,405	11,615	14,598	16,695
Water Year Types ^c												
Wet (32%)	16,321	14,503	5,956	1,838	556	821	1,566	2,800	5,549	8,332	12,662	15,076
Above Normal (16%)	18,382	16,247	11,996	3,877	1,315	1,117	2,572	5,187	8,889	9,989	13,111	16,172
Below Normal (13%)	17,464	16,252	14,340	9,380	4,209	4,509	6,025	8,066	10,735	11,815	14,246	16,646
Dry (24%)	18,017	17,906	16,397	11,276	5,292	3,963	5,852	8,586	11,134	13,928	16,268	17,842
Critical (15%)	18,909	19,009	17,657	13,499	8,845	7,956	9,697	12,188	14,217	16,449	17,943	18,901
Alternative 3 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-129	-71	104	1,292	322	101	15	282	-6	-94	39	109
20%	66	-68	1,201	1,017	-136	-28	660	129	183	-113	143	100
30%	-8	156	4,089	1,591	44	276	678	581	127	51	-76	119
40%	-174	1,344	4,088	673	129	-19	1,352	1,605	183	-39	-63	-29
50%	466	6,109	4,325	344	27	52	1,306	1,706	668	101	-104	373
60%	5,784	6,066	2,898	66	-124	62	1,014	1,842	333	164	-28	4,455
70%	9,562	9,299	1,233	55	23	60	603	1,166	770	207	-31	8,030
80%	9,619	8,756	1,789	16	0	-2	110	715	956	293	152	8,157
90%	8,890	4,008	298	-4	-2	-2	27	163	541	300	-160	8,184
Long Term												
Full Simulation Period ^b	3,661	3,563	1,839	429	32	7	494	833	356	72	34	3,048
Water Year Types ^c												
Wet (32%)	4,805	4,669	1,339	115	34	56	436	831	468	144	-45	7,357
Above Normal (16%)	2,636	3,022	2,162	292	-37	-32	665	1,370	491	125	118	4,399
Below Normal (13%)	5,891	4,887	2,771	640	-39	-77	730	1,016	390	26	-16	-143
Dry (24%)	3,188	3,265	2,308	767	23	11	507	719	233	-59	58	104
Critical (15%)	1,039	1,036	939	501	182	11	199	280	138	118	117	77

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.6.3. Sacramento River at Port Chicago Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	19,730	20,008	18,334	14,105	9,148	8,232	9,583	11,184	13,000	15,476	17,464	18,731
20%	18,797	18,624	16,981	13,083	6,541	6,730	7,154	10,189	11,980	14,499	16,437	18,010
30%	18,652	18,213	13,637	11,245	4,395	3,610	5,568	9,104	11,426	13,864	16,101	17,749
40%	18,408	16,690	12,775	7,827	3,132	3,345	4,140	6,598	10,912	12,195	14,895	17,115
50%	17,441	11,772	11,450	6,456	1,597	1,896	3,119	5,575	9,479	11,568	14,019	16,190
60%	11,807	11,409	10,666	3,956	900	1,287	2,061	3,971	8,998	10,011	13,690	11,771
70%	7,856	7,870	6,682	1,088	375	547	1,360	3,234	7,421	9,544	13,261	8,081
80%	7,557	7,426	2,822	458	241	279	544	1,621	5,586	9,137	12,824	7,783
90%	7,443	7,194	915	260	215	234	276	512	2,718	8,059	12,599	7,650
Long Term												
Full Simulation Period ^b	13,932	12,941	10,458	6,752	3,502	3,167	4,064	5,836	9,049	11,543	14,564	13,647
Water Year Types^c												
Wet (32%)	11,516	9,834	4,617	1,723	522	765	1,130	1,968	5,080	8,188	12,707	7,719
Above Normal (16%)	15,746	13,225	9,834	3,584	1,351	1,149	1,906	3,817	8,398	9,863	12,993	11,773
Below Normal (13%)	11,574	11,366	11,569	8,740	4,248	4,587	5,295	7,050	10,345	11,789	14,262	16,789
Dry (24%)	14,829	14,641	14,088	10,509	5,269	3,952	5,345	7,867	10,901	13,987	16,209	17,737
Critical (15%)	17,869	17,972	16,718	12,998	8,663	7,945	9,498	11,908	14,079	16,331	17,826	18,823

Alternative 5												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	19,671	19,928	18,427	14,102	9,160	8,238	9,021	10,101	12,872	15,473	17,497	18,640
20%	18,881	18,623	16,830	13,102	6,564	6,731	6,839	9,425	11,652	14,300	16,506	18,019
30%	18,675	18,214	13,606	11,246	4,461	3,671	5,402	8,451	11,347	13,834	16,111	17,778
40%	18,355	16,660	12,761	7,827	3,123	3,349	4,022	6,302	10,638	12,148	14,871	17,110
50%	17,303	11,760	11,441	6,544	1,586	1,937	3,151	5,365	9,405	11,573	14,025	16,097
60%	11,808	11,376	10,667	3,964	901	1,288	2,047	4,071	8,998	10,007	13,691	11,773
70%	7,855	7,870	6,629	1,050	374	549	1,361	3,141	7,415	9,553	13,240	8,077
80%	7,557	7,426	2,840	458	242	279	534	1,565	5,528	9,141	12,778	7,779
90%	7,421	7,158	918	260	215	234	276	512	2,720	8,060	12,527	7,654
Long Term												
Full Simulation Period ^b	13,926	12,905	10,448	6,773	3,525	3,175	3,856	5,492	8,886	11,483	14,521	13,637
Water Year Types^c												
Wet (32%)	11,518	9,853	4,623	1,716	521	764	1,123	1,906	5,057	8,128	12,644	7,714
Above Normal (16%)	15,737	13,001	9,726	3,580	1,351	1,151	1,893	3,739	8,360	9,861	12,989	11,791
Below Normal (13%)	11,582	11,371	11,574	8,749	4,245	4,589	5,035	6,665	10,227	11,761	14,219	16,736
Dry (24%)	14,818	14,623	14,111	10,544	5,280	3,961	4,937	7,305	10,677	13,950	16,187	17,734
Critical (15%)	17,842	17,956	16,710	13,091	8,802	7,985	9,020	11,066	13,537	16,140	17,744	18,798

Alternative 5 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-59	-80	93	-3	12	7	-563	-1,083	-128	-3	33	-90
20%	84	-1	-152	19	23	1	-315	-764	-328	-199	69	9
30%	23	1	-31	1	66	62	-165	-652	-79	-30	10	28
40%	-52	-30	-15	0	-10	4	-117	-297	-274	-48	-25	-5
50%	-138	-11	-9	89	-11	41	32	-210	-75	5	7	-93
60%	1	-33	0	8	1	1	-14	100	-1	-4	1	3
70%	-1	0	-53	-38	-1	2	1	-94	-6	9	-21	-4
80%	0	0	17	0	1	0	-10	-56	-58	4	-46	-4
90%	-22	-37	3	0	0	0	0	0	2	1	-72	4
Long Term												
Full Simulation Period ^b	-6	-36	-10	20	22	8	-208	-344	-163	-60	-44	-10
Water Year Types^c												
Wet (32%)	2	19	6	-7	-1	-1	-7	-62	-24	-60	-64	-5
Above Normal (16%)	-9	-224	-108	-4	0	1	-13	-78	-38	-3	-4	18
Below Normal (13%)	8	5	5	9	-3	2	-260	-385	-119	-28	-43	-53
Dry (24%)	-11	-18	23	35	11	9	-408	-562	-224	-37	-22	-3
Critical (15%)	-27	-17	-8	93	140	41	-478	-842	-542	-191	-82	-26

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
^b Based on the 82-year simulation period.
^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.6.4. Sacramento River at Port Chicago Salinity, Monthly EC

Second Basis of Comparison		Monthly EC (UMHOS/CM)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	19,528	19,670	18,458	16,317	11,450	9,775	9,970	11,470	12,921	15,419	17,642	18,754
20%	18,781	18,511	18,245	15,143	8,208	7,192	8,137	10,389	11,899	14,408	16,644	18,212
30%	18,464	18,288	17,776	13,850	6,202	4,623	7,006	9,726	11,120	13,945	16,271	17,825
40%	18,276	18,012	17,064	10,736	3,882	4,015	5,531	7,929	10,159	12,220	15,257	17,306
50%	17,910	17,816	15,892	8,667	2,317	2,512	4,449	6,938	9,682	11,671	14,270	16,776
60%	17,639	17,453	13,522	5,086	1,023	1,254	3,202	5,427	8,989	10,521	13,690	16,338
70%	17,457	17,101	9,437	1,366	409	580	1,800	4,229	7,936	10,081	13,519	16,216
80%	17,169	16,331	4,663	552	250	280	684	2,048	6,252	9,363	13,299	16,111
90%	16,142	11,709	1,298	259	213	231	299	641	2,883	8,098	12,857	15,830
Long Term												
Full Simulation Period ^b	17,560	16,411	12,505	8,064	4,282	3,590	4,752	6,585	9,029	11,657	14,774	16,778
Water Year Types^c												
Wet (32%)	16,378	14,448	6,247	2,204	618	796	1,551	2,617	5,097	8,394	12,877	15,144
Above Normal (16%)	18,219	16,129	12,396	4,832	1,758	1,190	2,668	5,003	8,342	10,048	13,307	16,244
Below Normal (13%)	17,333	16,030	14,313	11,108	5,397	5,006	6,359	8,011	9,893	11,859	14,672	16,968
Dry (24%)	18,060	17,861	16,486	12,568	6,575	4,754	6,193	8,509	10,937	13,951	16,360	17,883
Critical (15%)	18,781	18,899	17,889	13,966	10,113	9,008	10,068	12,383	14,322	16,464	17,923	18,883

No Action Alternative		Monthly EC (UMHOS/CM)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	19,730	20,008	18,334	14,105	9,148	8,232	9,583	11,184	13,000	15,476	17,464	18,731
20%	18,797	18,624	16,981	13,083	6,541	6,730	7,154	10,189	11,980	14,499	16,437	18,010
30%	18,652	18,213	13,637	11,245	4,395	3,610	5,568	9,104	11,426	13,864	16,101	17,749
40%	18,408	16,690	12,775	7,827	3,132	3,345	4,140	6,598	10,912	12,195	14,895	17,115
50%	17,441	11,772	11,450	6,456	1,597	1,896	3,119	5,575	9,479	11,568	14,019	16,190
60%	11,807	11,409	10,666	3,956	900	1,287	2,061	3,971	8,998	10,011	13,690	11,771
70%	7,856	7,870	6,682	1,088	375	547	1,360	3,234	7,421	9,544	13,261	8,081
80%	7,557	7,426	2,822	458	241	279	544	1,621	5,586	9,137	12,824	7,783
90%	7,443	7,194	915	260	215	234	276	512	2,718	8,059	12,599	7,650
Long Term												
Full Simulation Period ^b	13,932	12,941	10,458	6,752	3,502	3,167	4,064	5,836	9,049	11,543	14,564	13,647
Water Year Types^c												
Wet (32%)	11,516	9,834	4,617	1,723	522	765	1,130	1,968	5,080	8,188	12,707	7,719
Above Normal (16%)	15,746	13,225	9,834	3,584	1,351	1,149	1,906	3,817	8,398	9,863	12,993	11,773
Below Normal (13%)	11,574	11,366	11,569	8,740	4,248	4,587	5,295	7,050	10,345	11,789	14,262	16,789
Dry (24%)	14,829	14,641	14,088	10,509	5,269	3,952	5,345	7,867	10,901	13,987	16,209	17,737
Critical (15%)	17,869	17,972	16,718	12,998	8,663	7,945	9,498	11,908	14,079	16,331	17,826	18,823

No Action Alternative minus Second Basis of Comparison		Monthly EC (UMHOS/CM)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	202	337	-124	-2,212	-2,301	-1,543	-387	-287	80	57	-178	-23
20%	16	113	-1,264	-2,059	-1,667	-462	-983	-200	80	91	-207	-201
30%	187	-75	-4,139	-2,606	-1,807	-1,013	-1,438	-622	306	-81	-171	-76
40%	131	-1,322	-4,288	-2,909	-750	-670	-1,391	-1,331	753	-24	-362	-191
50%	-469	-6,044	-4,442	-2,211	-721	-616	-1,330	-1,363	-202	-103	-251	-586
60%	-5,832	-6,045	-2,855	-1,130	-123	33	-1,141	-1,457	10	-510	0	-4,567
70%	-9,601	-9,231	-2,755	-279	-34	-33	-440	-994	-515	-537	-258	-8,135
80%	-9,612	-8,905	-1,840	-94	-10	-2	-141	-427	-666	-226	-474	-8,329
90%	-8,699	-4,515	-383	0	2	3	-24	-129	-165	-39	-258	-8,180
Long Term												
Full Simulation Period ^b	-3,628	-3,470	-2,047	-1,312	-780	-424	-687	-749	20	-114	-210	-3,131
Water Year Types^c												
Wet (32%)	-4,862	-4,614	-1,630	-481	-96	-31	-421	-649	-17	-206	-170	-7,425
Above Normal (16%)	-2,473	-2,904	-2,562	-1,248	-407	-41	-762	-1,186	56	-184	-314	-4,471
Below Normal (13%)	-5,759	-4,664	-2,744	-2,368	-1,149	-419	-1,064	-960	453	-70	-410	-178
Dry (24%)	-3,231	-3,221	-2,397	-2,059	-1,306	-801	-848	-642	-36	36	-151	-146
Critical (15%)	-912	-926	-1,171	-968	-1,450	-1,063	-570	-475	-244	-133	-96	-59

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
b Based on the 82-year simulation period.
c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.6.5. Sacramento River at Port Chicago Salinity, Monthly EC

Second Basis of Comparison		Monthly EC (UMHOS/CM)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	19,528	19,670	18,458	16,317	11,450	9,775	9,970	11,470	12,921	15,419	17,642	18,754
20%	18,781	18,511	18,245	15,143	8,208	7,192	8,137	10,389	11,899	14,408	16,644	18,212
30%	18,464	18,288	17,776	13,850	6,202	4,623	7,006	9,726	11,120	13,945	16,271	17,825
40%	18,276	18,012	17,064	10,736	3,882	4,015	5,531	7,929	10,159	12,220	15,257	17,306
50%	17,910	17,816	15,892	8,667	2,317	2,512	4,449	6,938	9,682	11,671	14,270	16,776
60%	17,639	17,453	13,522	5,086	1,023	1,254	3,202	5,427	8,989	10,521	13,690	16,338
70%	17,457	17,101	9,437	1,366	409	580	1,800	4,229	7,936	10,081	13,519	16,216
80%	17,169	16,331	4,663	552	250	280	684	2,048	6,252	9,363	13,299	16,111
90%	16,142	11,709	1,298	259	213	231	299	641	2,883	8,098	12,857	15,830
Long Term												
Full Simulation Period ^b	17,560	16,411	12,505	8,064	4,282	3,590	4,752	6,585	9,029	11,657	14,774	16,778
Water Year Types ^c												
Wet (32%)	16,378	14,448	6,247	2,204	618	796	1,551	2,617	5,097	8,394	12,877	15,144
Above Normal (16%)	18,219	16,129	12,396	4,832	1,758	1,190	2,668	5,003	8,342	10,048	13,307	16,244
Below Normal (13%)	17,333	16,030	14,313	11,108	5,397	5,006	6,359	8,011	9,893	11,859	14,672	16,968
Dry (24%)	18,060	17,861	16,486	12,568	6,575	4,754	6,193	8,509	10,937	13,951	16,360	17,883
Critical (15%)	18,781	18,899	17,889	13,966	10,113	9,008	10,068	12,383	14,322	16,464	17,923	18,883

Alternative 3

Alternative 3		Monthly EC (UMHOS/CM)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	19,601	19,937	18,438	15,398	9,470	8,333	9,599	11,466	12,994	15,382	17,503	18,839
20%	18,862	18,556	18,182	14,100	6,405	6,703	7,815	10,318	12,163	14,385	16,580	18,110
30%	18,644	18,369	17,725	12,836	4,439	3,885	6,246	9,685	11,553	13,916	16,025	17,869
40%	18,234	18,034	16,863	8,500	3,261	3,326	5,492	8,203	11,095	12,157	14,832	17,086
50%	17,907	17,880	15,775	6,800	1,624	1,948	4,425	7,281	10,148	11,669	13,914	16,563
60%	17,591	17,474	13,564	4,021	776	1,348	3,075	5,812	9,331	10,176	13,662	16,225
70%	17,419	17,169	7,915	1,142	398	607	1,963	4,400	8,191	9,751	13,230	16,111
80%	17,176	16,182	4,611	474	241	276	654	2,337	6,542	9,430	12,977	15,940
90%	16,334	11,202	1,212	256	213	232	302	675	3,259	8,360	12,439	15,833
Long Term												
Full Simulation Period ^b	17,594	16,503	12,297	7,181	3,534	3,173	4,559	6,670	9,405	11,615	14,598	16,695
Water Year Types ^c												
Wet (32%)	16,321	14,503	5,956	1,838	556	821	1,566	2,800	5,549	8,332	12,662	15,076
Above Normal (16%)	18,382	16,247	11,996	3,877	1,315	1,117	2,572	5,187	8,889	9,989	13,111	16,172
Below Normal (13%)	17,464	16,252	14,340	9,380	4,209	4,509	6,025	8,066	10,735	11,815	14,246	16,646
Dry (24%)	18,017	17,906	16,397	11,276	5,292	3,963	5,852	8,586	11,134	13,928	16,268	17,842
Critical (15%)	18,909	19,009	17,657	13,499	8,845	7,956	9,697	12,188	14,217	16,449	17,943	18,901

Alternative 3 minus Second Basis of Comparison

Alternative 3 minus Second Basis of Comparison		Monthly EC (UMHOS/CM)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	74	266	-20	-919	-1,979	-1,442	-371	-5	73	-37	-139	85
20%	81	45	-63	-1,043	-1,803	-490	-323	-71	263	-23	-64	-101
30%	180	81	-51	-1,015	-1,763	-738	-760	-40	433	-30	-247	43
40%	-43	22	-201	-2,236	-621	-689	-39	274	936	-63	-425	-220
50%	-3	65	-117	-1,867	-694	-564	-23	343	466	-2	-356	-213
60%	-48	21	42	-1,065	-248	94	-127	385	342	-345	-28	-113
70%	-38	67	-1,522	-224	-11	27	163	172	255	-330	-289	-105
80%	7	-149	-52	-78	-9	-4	-31	289	290	67	-322	-171
90%	192	-507	-86	-3	0	1	3	34	376	261	-418	3
Long Term												
Full Simulation Period ^b	34	93	-208	-883	-748	-417	-193	85	375	-42	-176	-83
Water Year Types ^c												
Wet (32%)	-57	55	-291	-367	-62	25	15	182	452	-62	-215	-68
Above Normal (16%)	163	118	-400	-955	-444	-73	-97	184	547	-59	-196	-71
Below Normal (13%)	132	223	27	-1,728	-1,188	-496	-334	56	842	-44	-426	-321
Dry (24%)	-42	44	-89	-1,292	-1,283	-790	-341	77	197	-23	-93	-42
Critical (15%)	127	110	-232	-467	-1,268	-1,052	-371	-194	-106	-15	21	18

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.6.6. Sacramento River at Port Chicago Salinity, Monthly EC

Second Basis of Comparison		Monthly EC (UMHOS/CM)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	19,528	19,670	18,458	16,317	11,450	9,775	9,970	11,470	12,921	15,419	17,642	18,754
20%	18,781	18,511	18,245	15,143	8,208	7,192	8,137	10,389	11,899	14,408	16,644	18,212
30%	18,464	18,288	17,776	13,850	6,202	4,623	7,006	9,726	11,120	13,945	16,271	17,825
40%	18,276	18,012	17,064	10,736	3,882	4,015	5,531	7,929	10,159	12,220	15,257	17,306
50%	17,910	17,816	15,892	8,667	2,317	2,512	4,449	6,938	9,682	11,671	14,270	16,776
60%	17,639	17,453	13,522	5,086	1,023	1,254	3,202	5,427	8,989	10,521	13,690	16,338
70%	17,457	17,101	9,437	1,366	409	580	1,800	4,229	7,936	10,081	13,519	16,216
80%	17,169	16,331	4,663	552	250	280	684	2,048	6,252	9,363	13,299	16,111
90%	16,142	11,709	1,298	259	213	231	299	641	2,883	8,098	12,857	15,830
Long Term												
Full Simulation Period ^b	17,560	16,411	12,505	8,064	4,282	3,590	4,752	6,585	9,029	11,657	14,774	16,778
Water Year Types ^c												
Wet (32%)	16,378	14,448	6,247	2,204	618	796	1,551	2,617	5,097	8,394	12,877	15,144
Above Normal (16%)	18,219	16,129	12,396	4,832	1,758	1,190	2,668	5,003	8,342	10,048	13,307	16,244
Below Normal (13%)	17,333	16,030	14,313	11,108	5,397	5,006	6,359	8,011	9,893	11,859	14,672	16,968
Dry (24%)	18,060	17,861	16,486	12,568	6,575	4,754	6,193	8,509	10,937	13,951	16,360	17,883
Critical (15%)	18,781	18,899	17,889	13,966	10,113	9,008	10,068	12,383	14,322	16,464	17,923	18,883

Alternative 5

Alternative 5		Monthly EC (UMHOS/CM)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	19,671	19,928	18,427	14,102	9,160	8,238	9,021	10,101	12,872	15,473	17,497	18,640
20%	18,881	18,623	16,830	13,102	6,564	6,731	6,839	9,425	11,652	14,300	16,506	18,019
30%	18,675	18,214	13,606	11,246	4,461	3,671	5,402	8,451	11,347	13,834	16,111	17,778
40%	18,355	16,660	12,761	7,827	3,123	3,349	4,022	6,302	10,638	12,148	14,871	17,110
50%	17,303	11,760	11,441	6,544	1,586	1,937	3,151	5,365	9,405	11,573	14,025	16,097
60%	11,808	11,376	10,667	3,964	901	1,288	2,047	4,071	8,998	10,007	13,691	11,773
70%	7,855	7,870	6,629	1,050	374	549	1,361	3,141	7,415	9,553	13,240	8,077
80%	7,557	7,426	2,840	458	242	279	534	1,565	5,528	9,141	12,778	7,779
90%	7,421	7,158	918	260	215	234	276	512	2,720	8,060	12,527	7,654
Long Term												
Full Simulation Period ^b	13,926	12,905	10,448	6,773	3,525	3,175	3,856	5,492	8,886	11,483	14,521	13,637
Water Year Types ^c												
Wet (32%)	11,518	9,853	4,623	1,716	521	764	1,123	1,906	5,057	8,128	12,644	7,714
Above Normal (16%)	15,737	13,001	9,726	3,580	1,351	1,151	1,893	3,739	8,360	9,861	12,989	11,791
Below Normal (13%)	11,582	11,371	11,574	8,749	4,245	4,589	5,035	6,665	10,227	11,761	14,219	16,736
Dry (24%)	14,818	14,623	14,111	10,544	5,280	3,961	4,937	7,305	10,677	13,950	16,187	17,734
Critical (15%)	17,842	17,956	16,710	13,091	8,802	7,985	9,020	11,066	13,537	16,140	17,744	18,798

Alternative 5 minus Second Basis of Comparison

Alternative 5 minus Second Basis of Comparison		Monthly EC (UMHOS/CM)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	143	257	-31	-2,215	-2,289	-1,537	-949	-1,370	-48	54	-146	-113
20%	100	112	-1,416	-2,041	-1,644	-461	-1,298	-964	-248	-108	-138	-192
30%	211	-74	-4,170	-2,604	-1,741	-952	-1,603	-1,274	227	-111	-161	-48
40%	79	-1,352	-4,303	-2,909	-759	-666	-1,508	-1,628	479	-72	-386	-196
50%	-607	-6,055	-4,451	-2,122	-731	-575	-1,298	-1,573	-277	-98	-245	-679
60%	-5,831	-6,077	-2,855	-1,122	-122	34	-1,155	-1,356	9	-514	1	-4,565
70%	-9,602	-9,232	-2,808	-317	-35	-31	-439	-1,088	-521	-528	-279	-8,139
80%	-9,612	-8,904	-1,823	-94	-9	-1	-151	-482	-724	-222	-520	-8,332
90%	-8,721	-4,551	-380	0	2	3	-24	-129	-163	-38	-330	-8,176
Long Term												
Full Simulation Period ^b	-3,634	-3,506	-2,057	-1,291	-758	-415	-896	-1,093	-144	-175	-253	-3,142
Water Year Types ^c												
Wet (32%)	-4,860	-4,595	-1,624	-488	-97	-32	-428	-712	-40	-266	-233	-7,430
Above Normal (16%)	-2,482	-3,128	-2,670	-1,252	-407	-40	-775	-1,264	18	-187	-318	-4,452
Below Normal (13%)	-5,751	-4,659	-2,739	-2,359	-1,152	-417	-1,324	-1,346	334	-98	-453	-231
Dry (24%)	-3,241	-3,239	-2,374	-2,024	-1,295	-793	-1,256	-1,204	-260	-1	-173	-149
Critical (15%)	-939	-943	-1,179	-876	-1,311	-1,023	-1,048	-1,317	-786	-324	-178	-85

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 **B.7. Jones Pumping Plant Salinity**

Figure 6E.B.7.1. Jones Pumping Plant Salinity, Electrical Conductivity, October

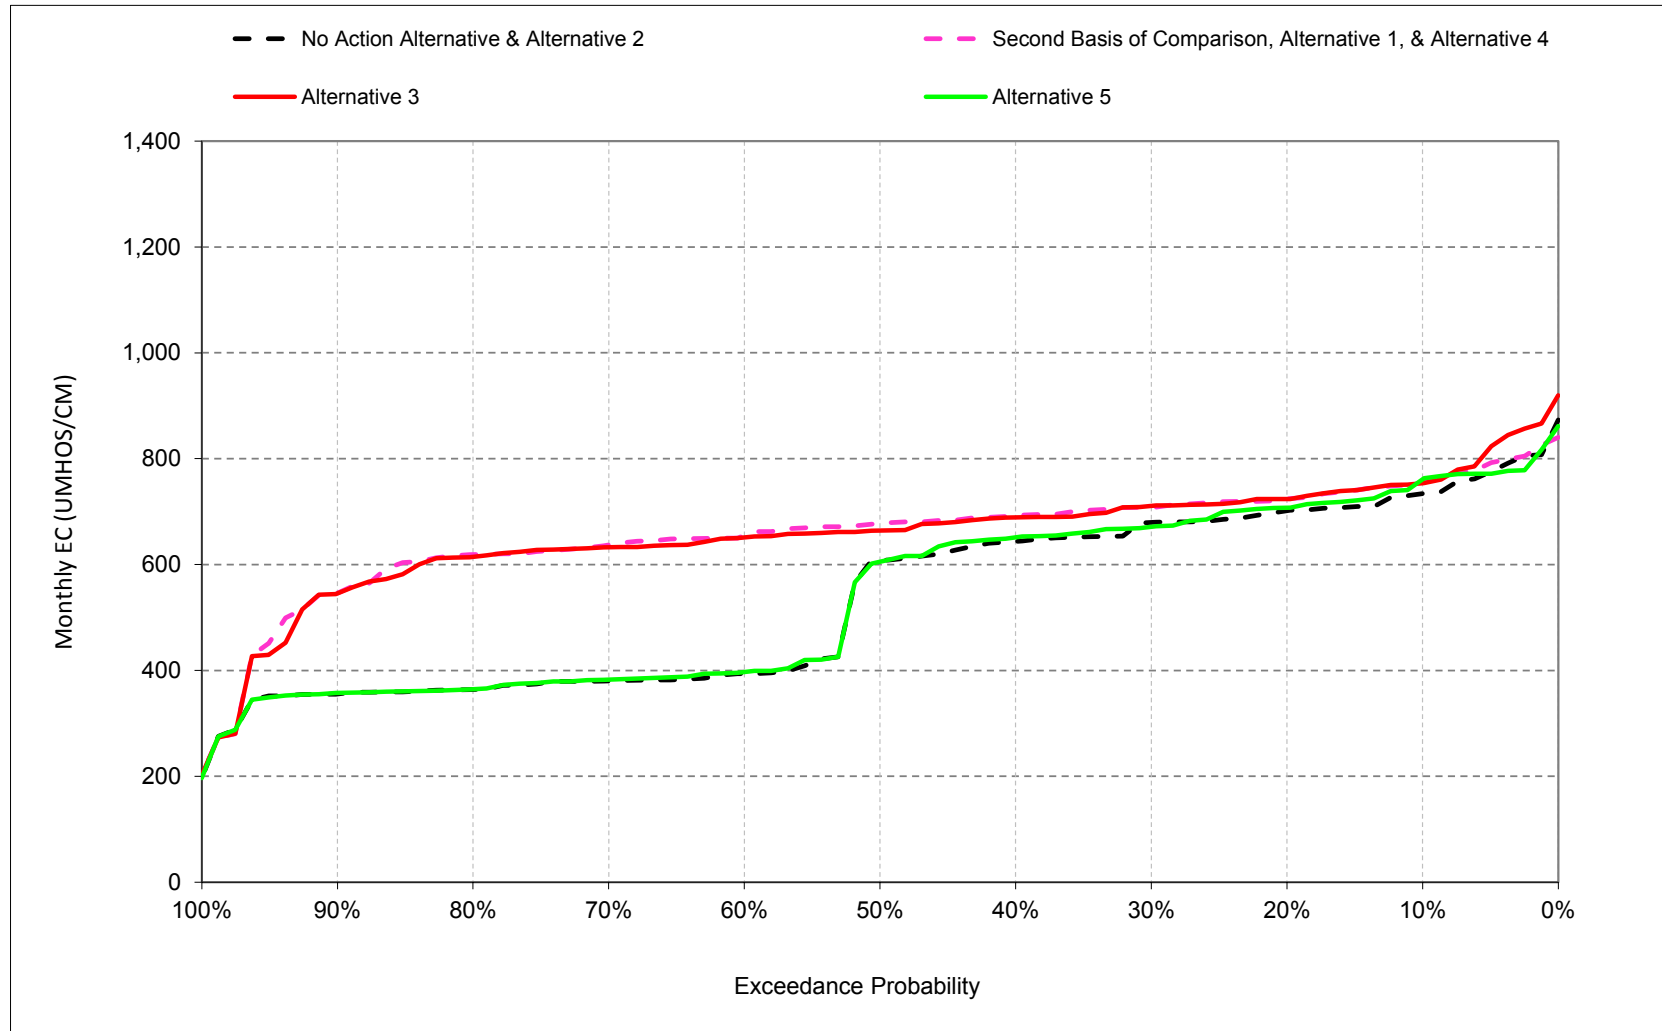


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.7.2. Jones Pumping Plant Salinity, Electrical Conductivity, November

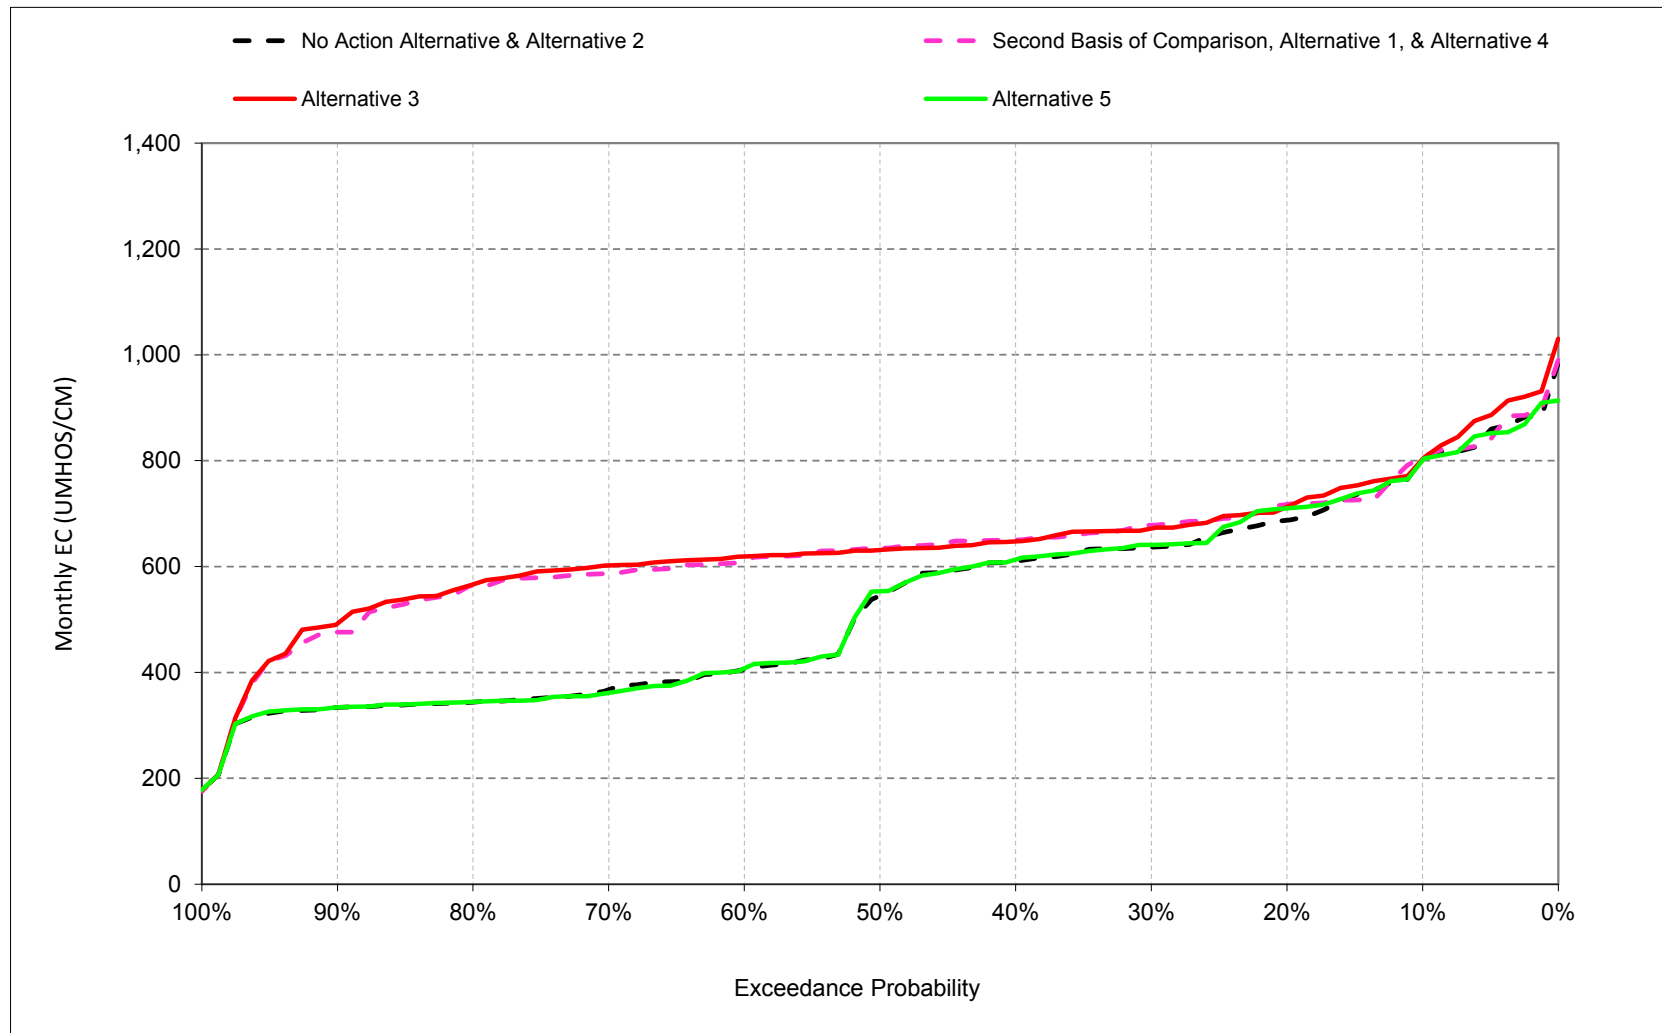


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.7.3. Jones Pumping Plant Salinity, Electrical Conductivity, December

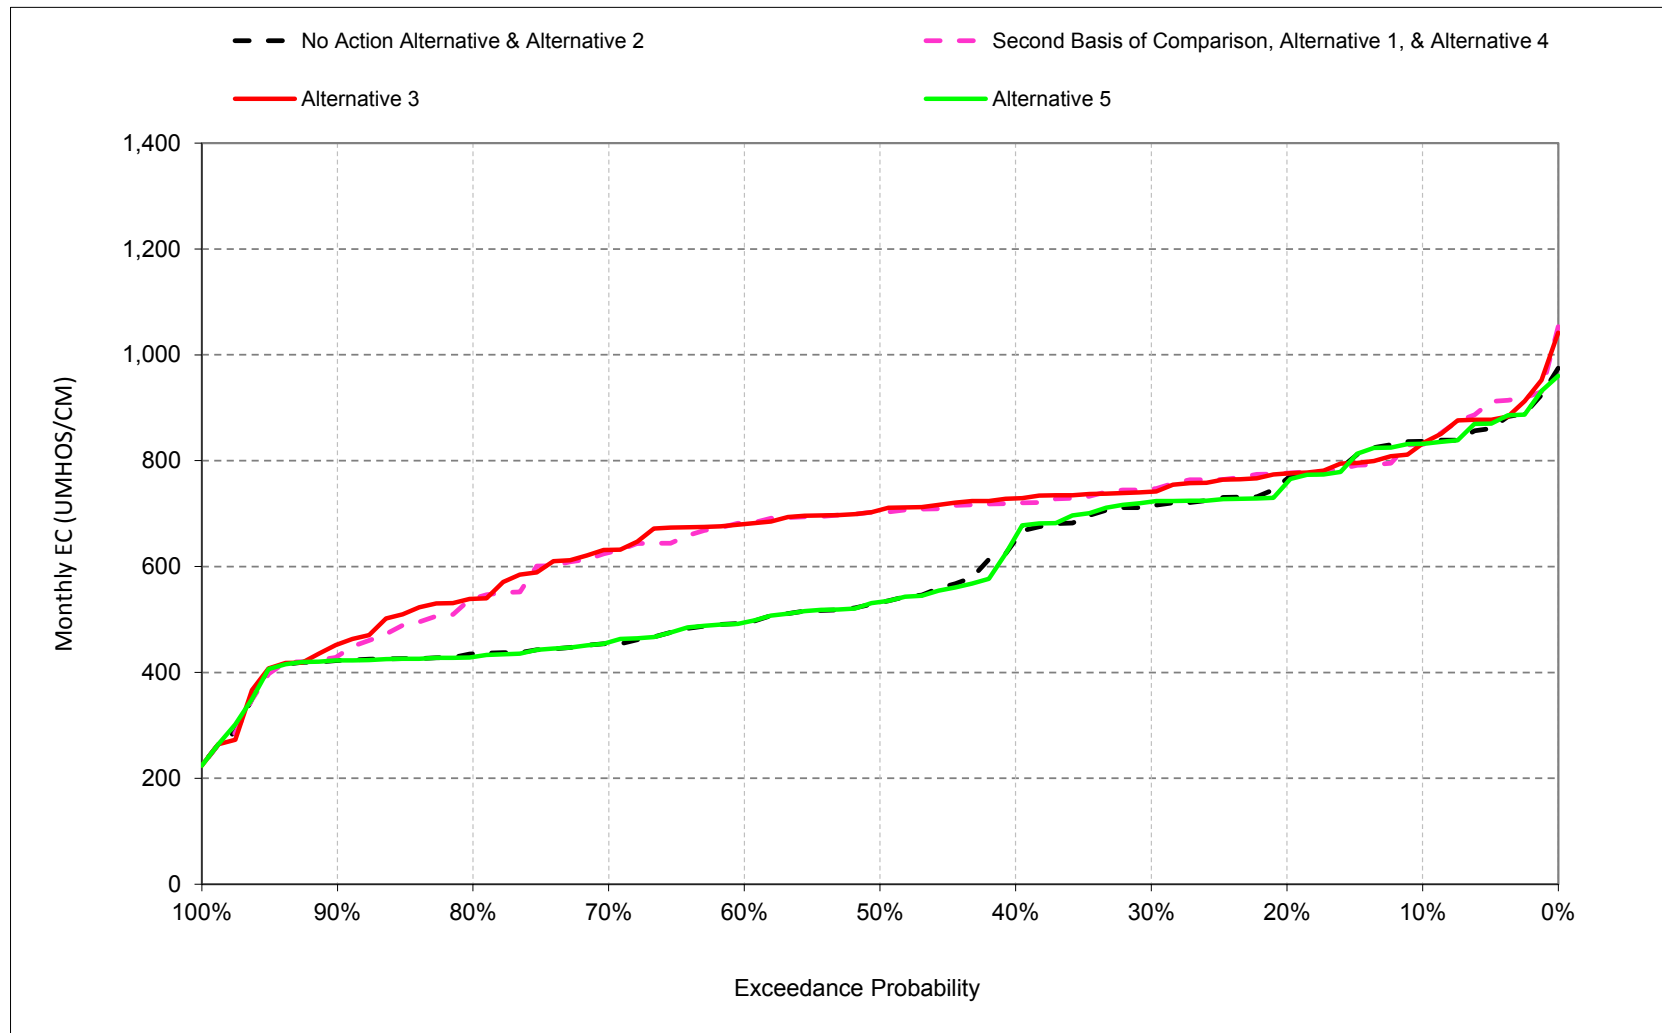


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.7.4. Jones Pumping Plant Salinity, Electrical Conductivity, January

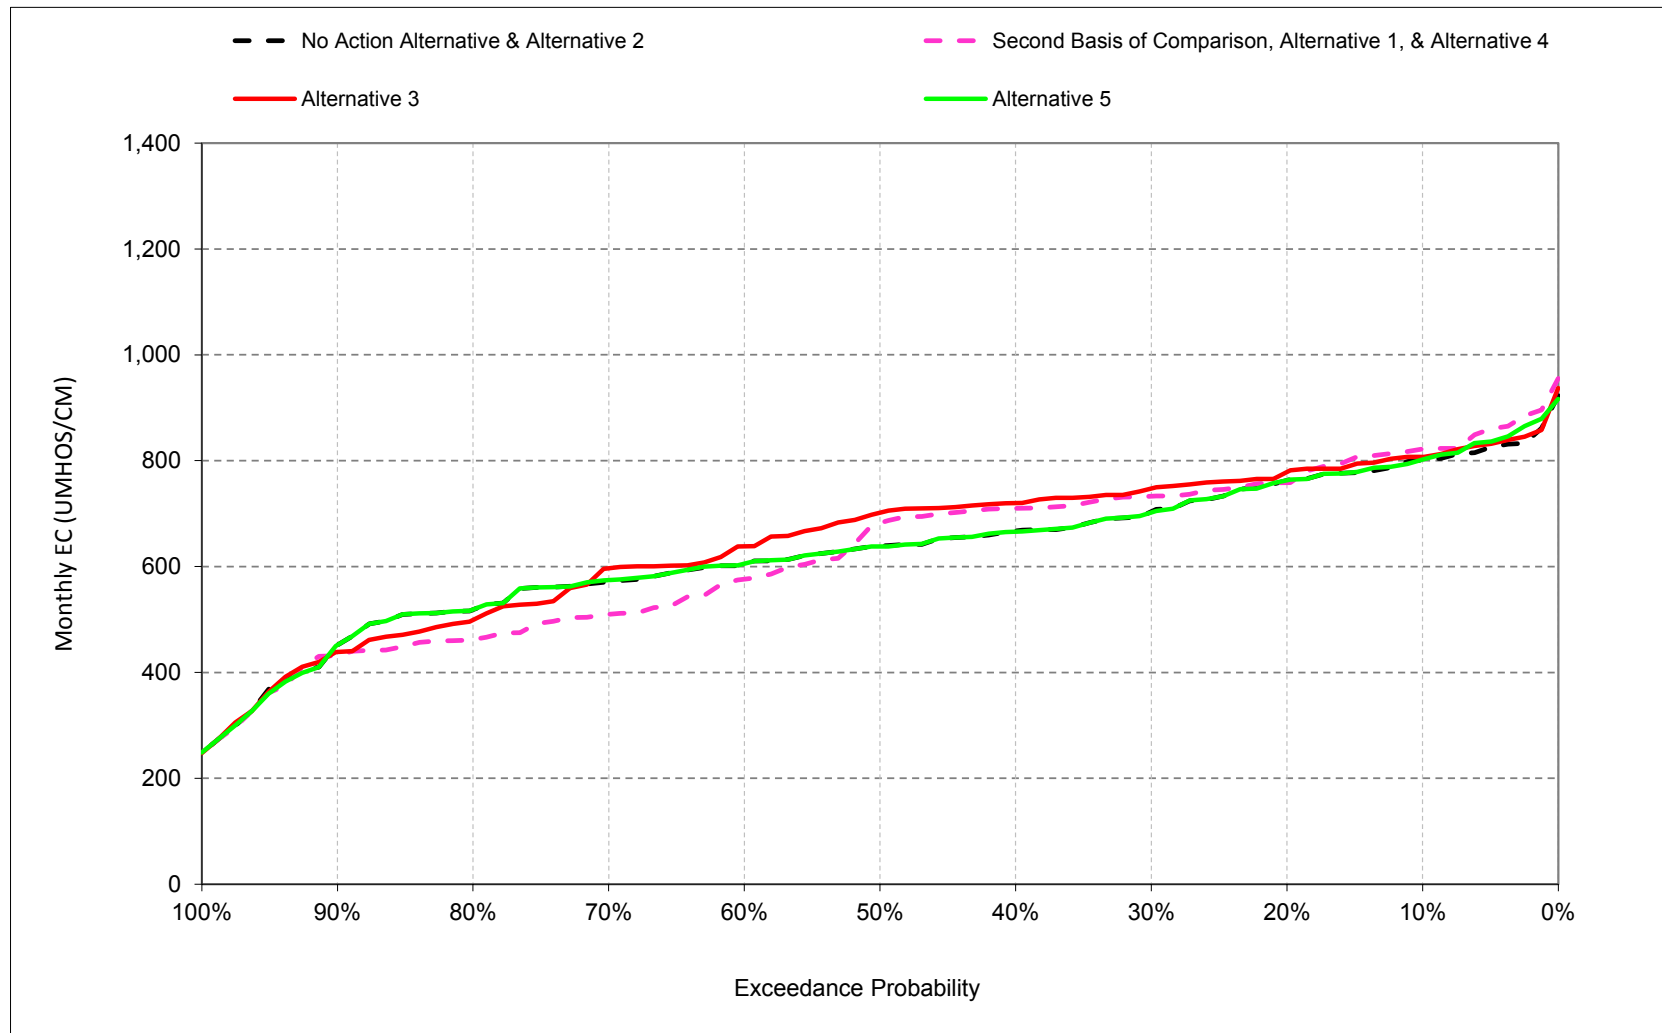


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.7.5. Jones Pumping Plant Salinity, Electrical Conductivity, February

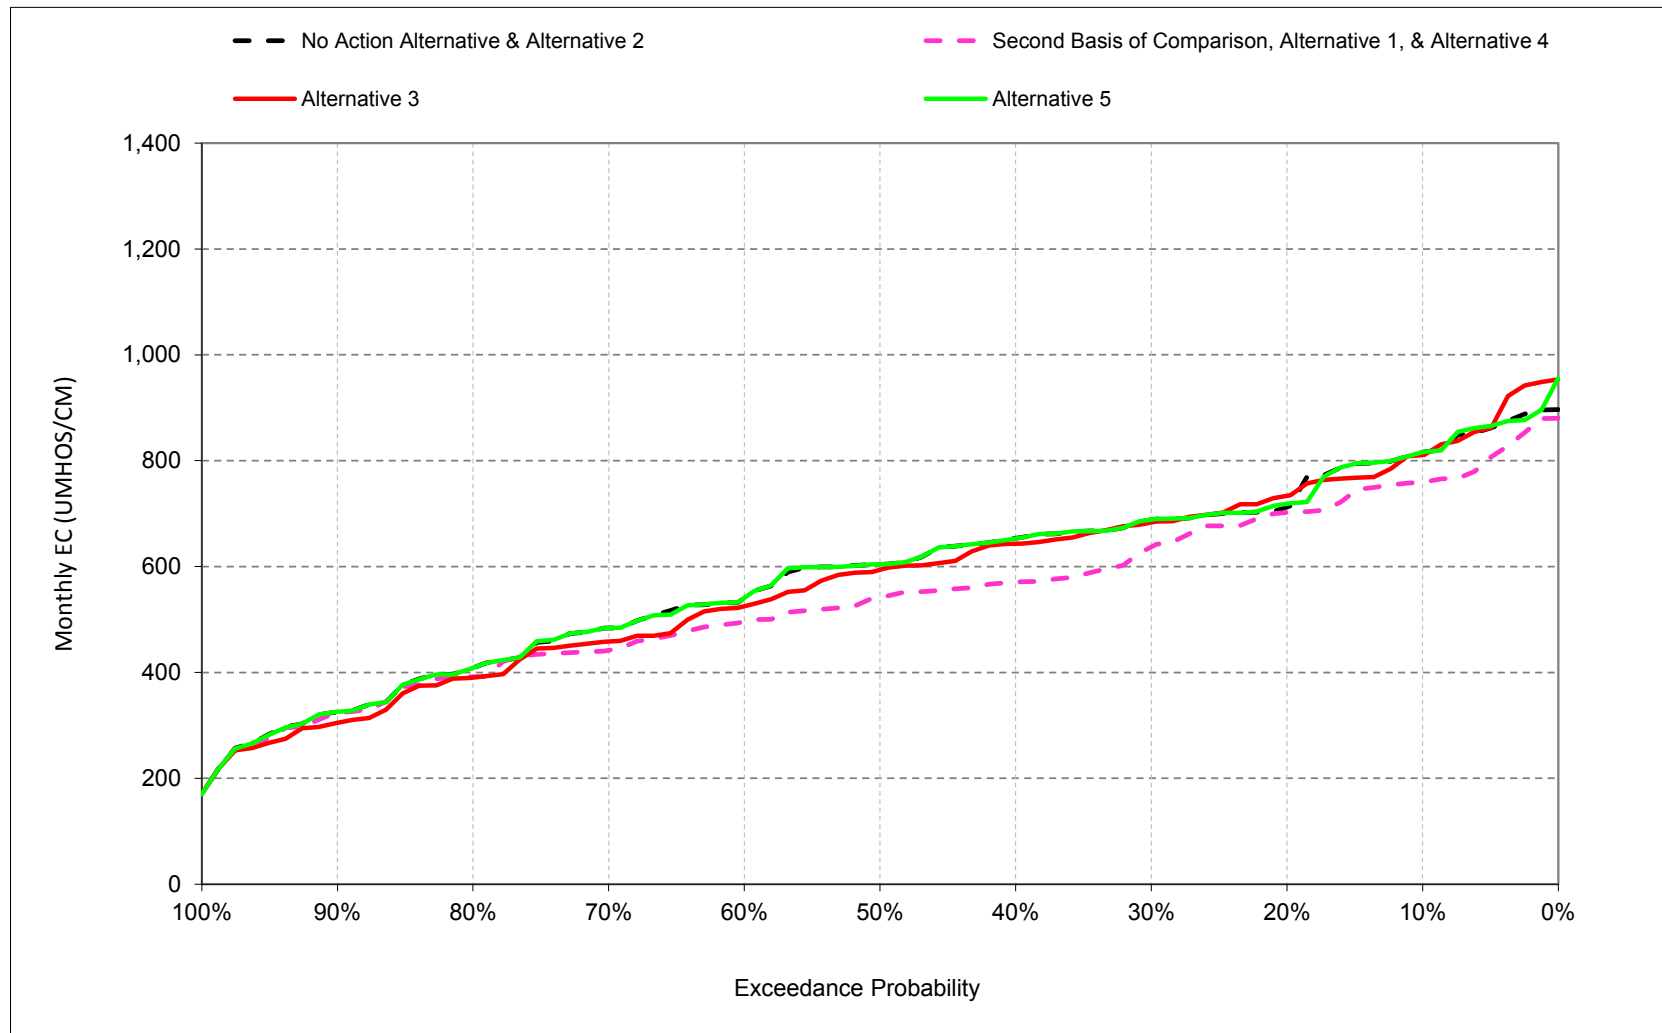


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.7.6. Jones Pumping Plant Salinity, Electrical Conductivity, March

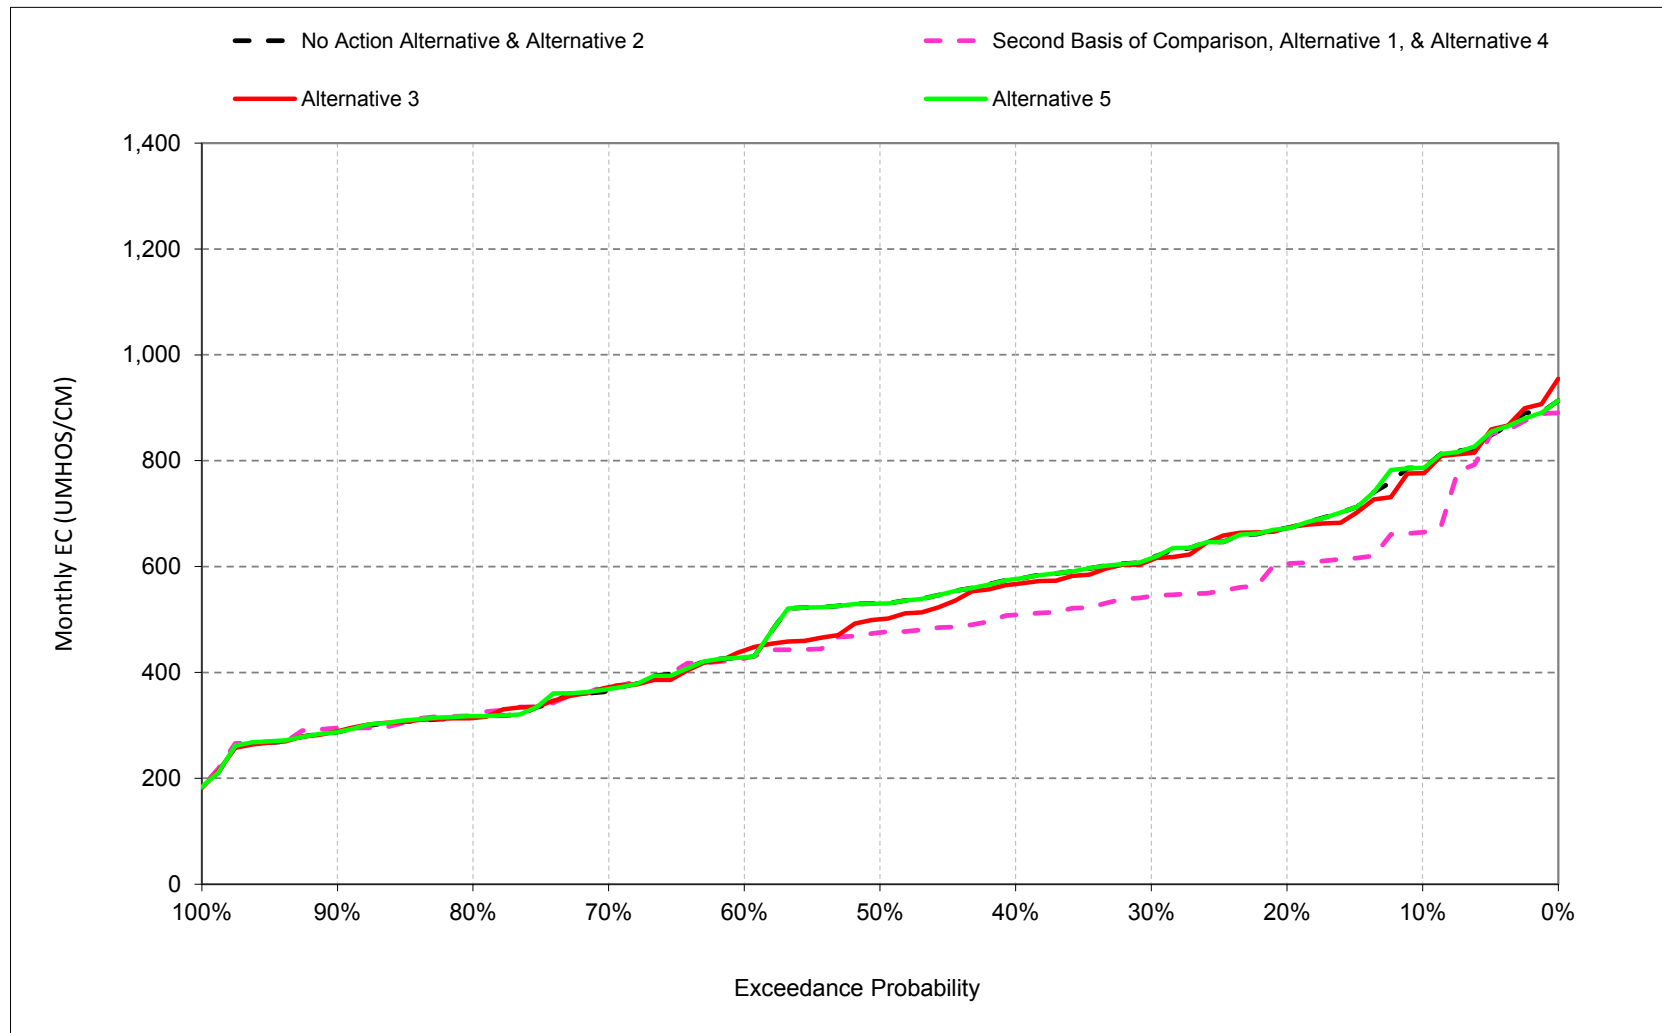


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.7.7. Jones Pumping Plant Salinity, Electrical Conductivity, April

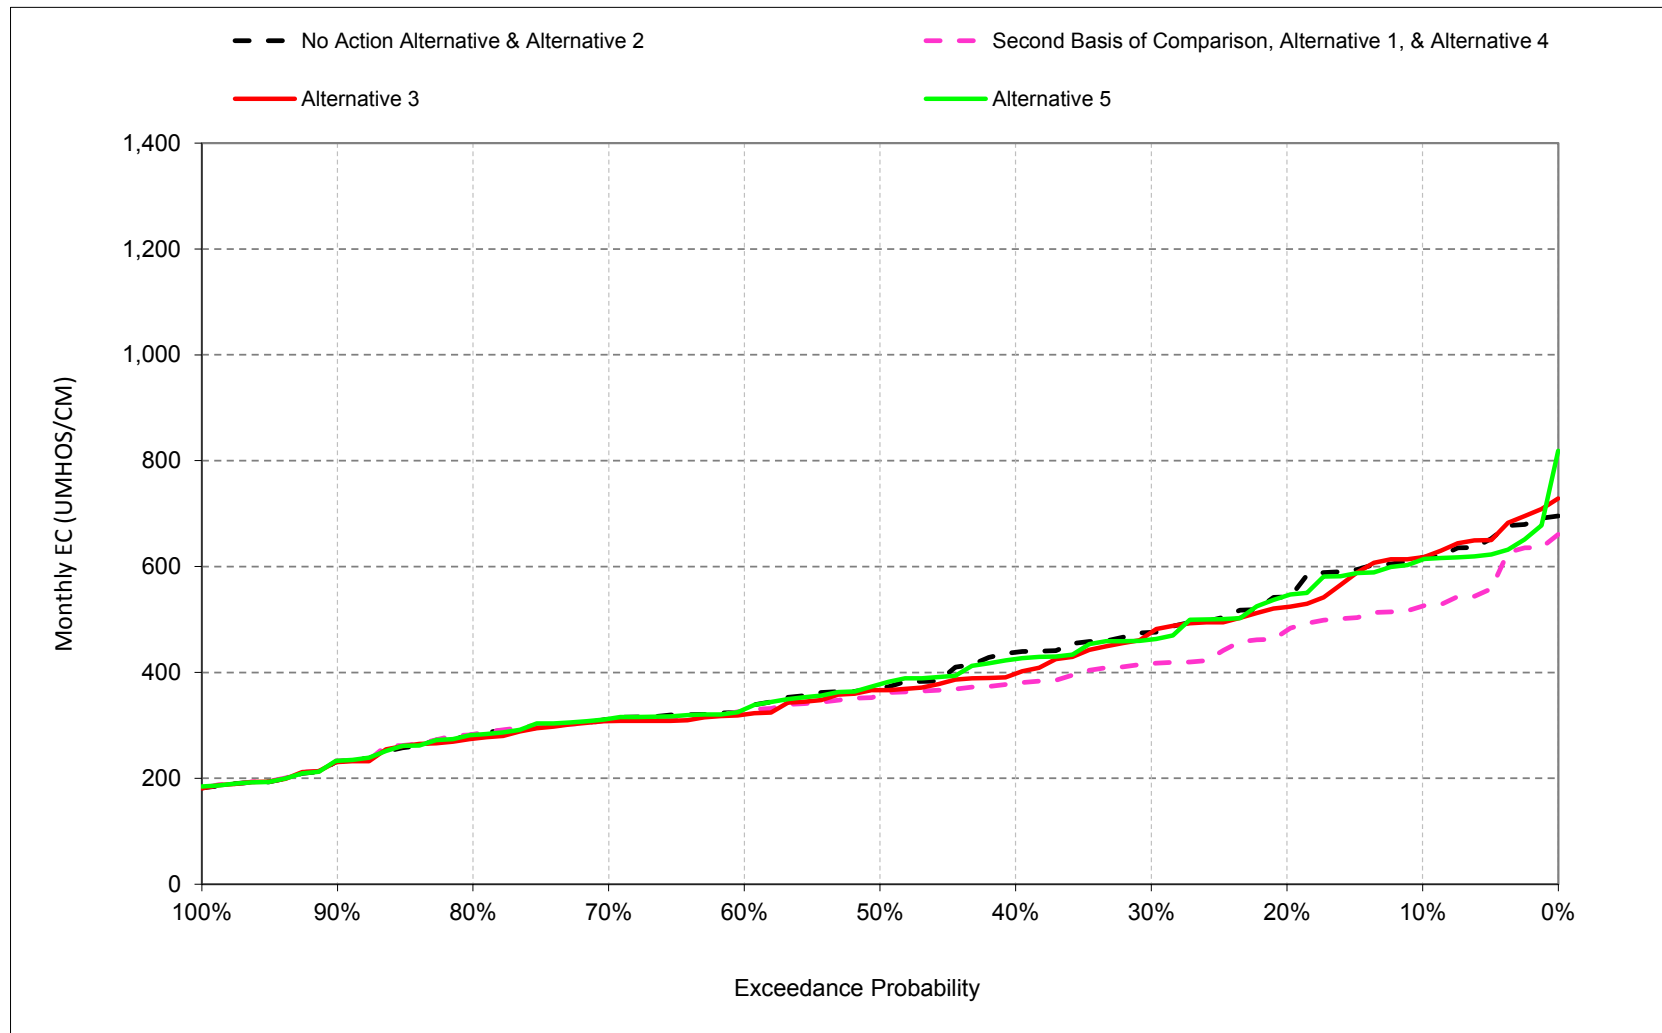


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.7.8. Jones Pumping Plant Salinity, Electrical Conductivity, May

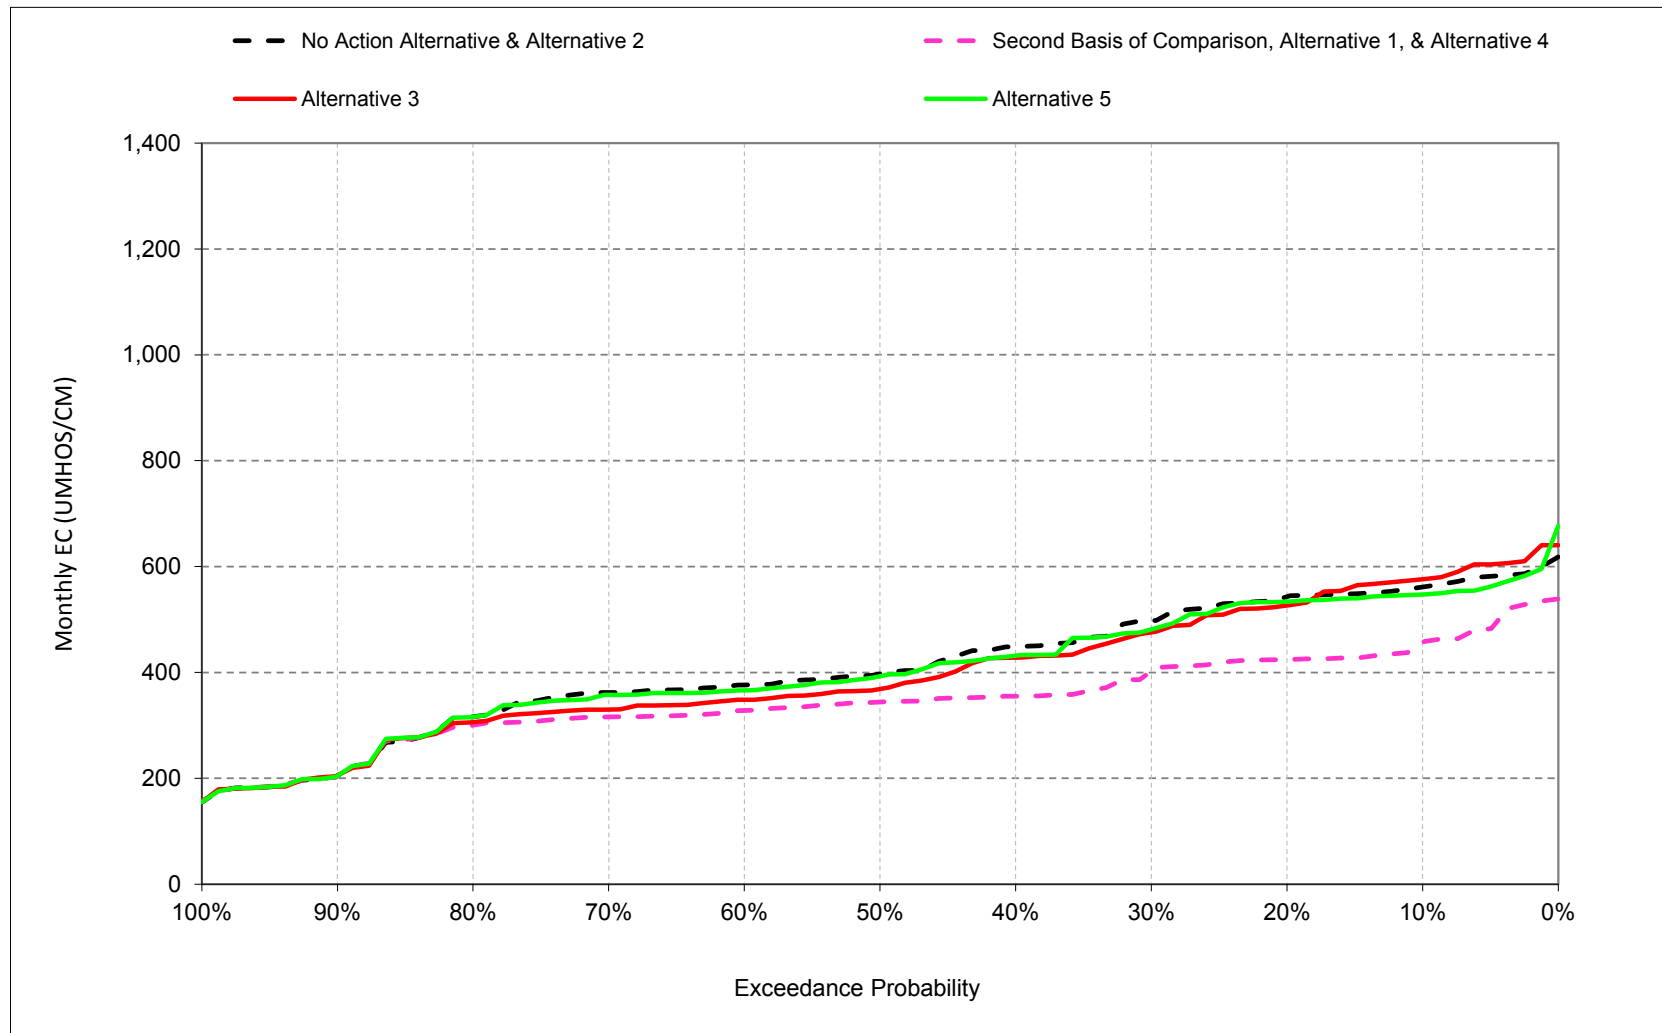


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.7.9. Jones Pumping Plant Salinity, Electrical Conductivity, June

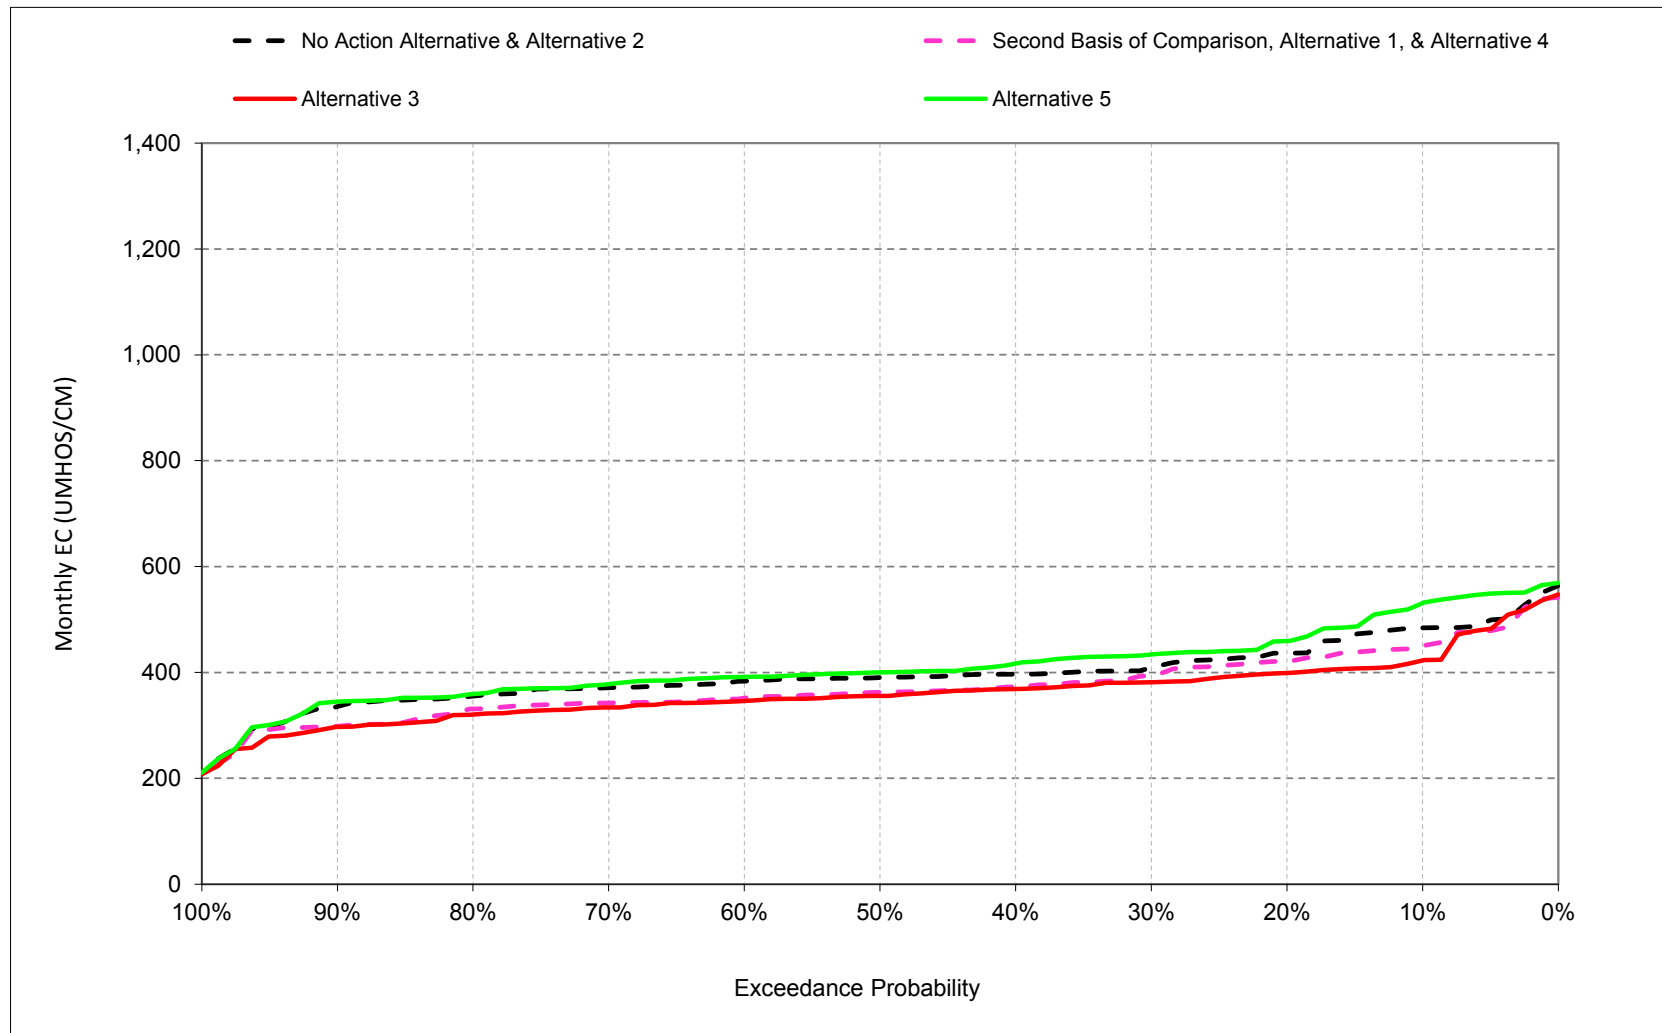


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.7.10. Jones Pumping Plant Salinity, Electrical Conductivity, July

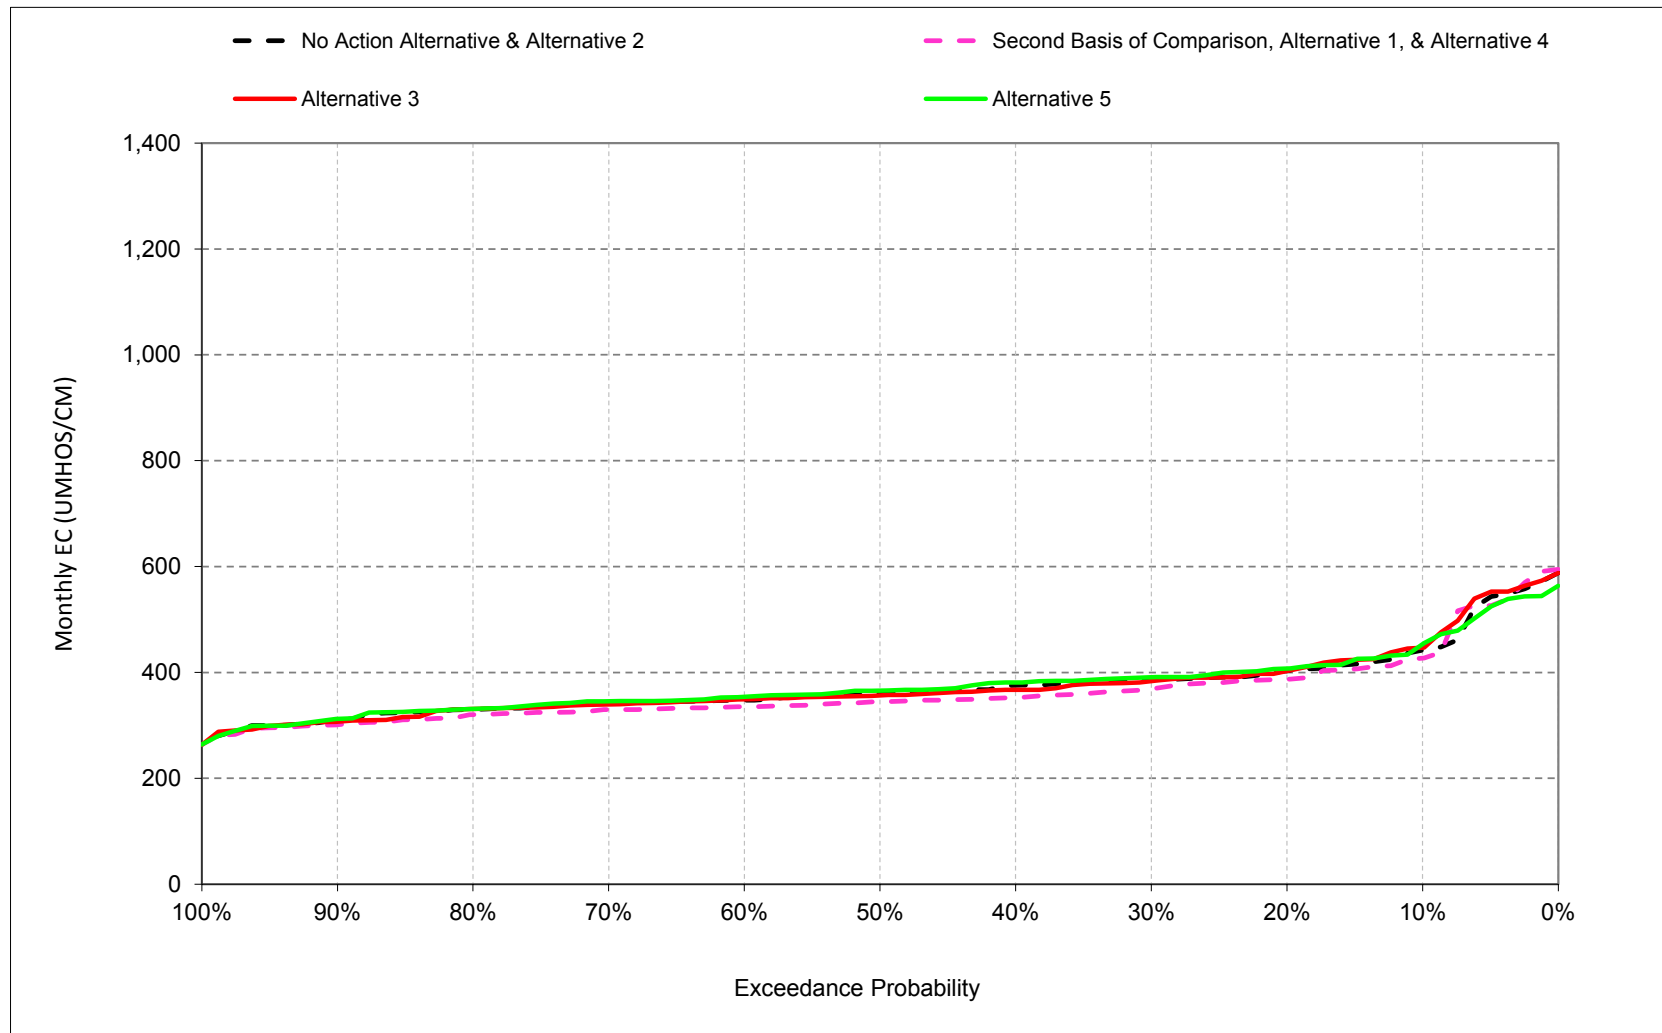


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.7.11. Jones Pumping Plant Salinity, Electrical Conductivity, August

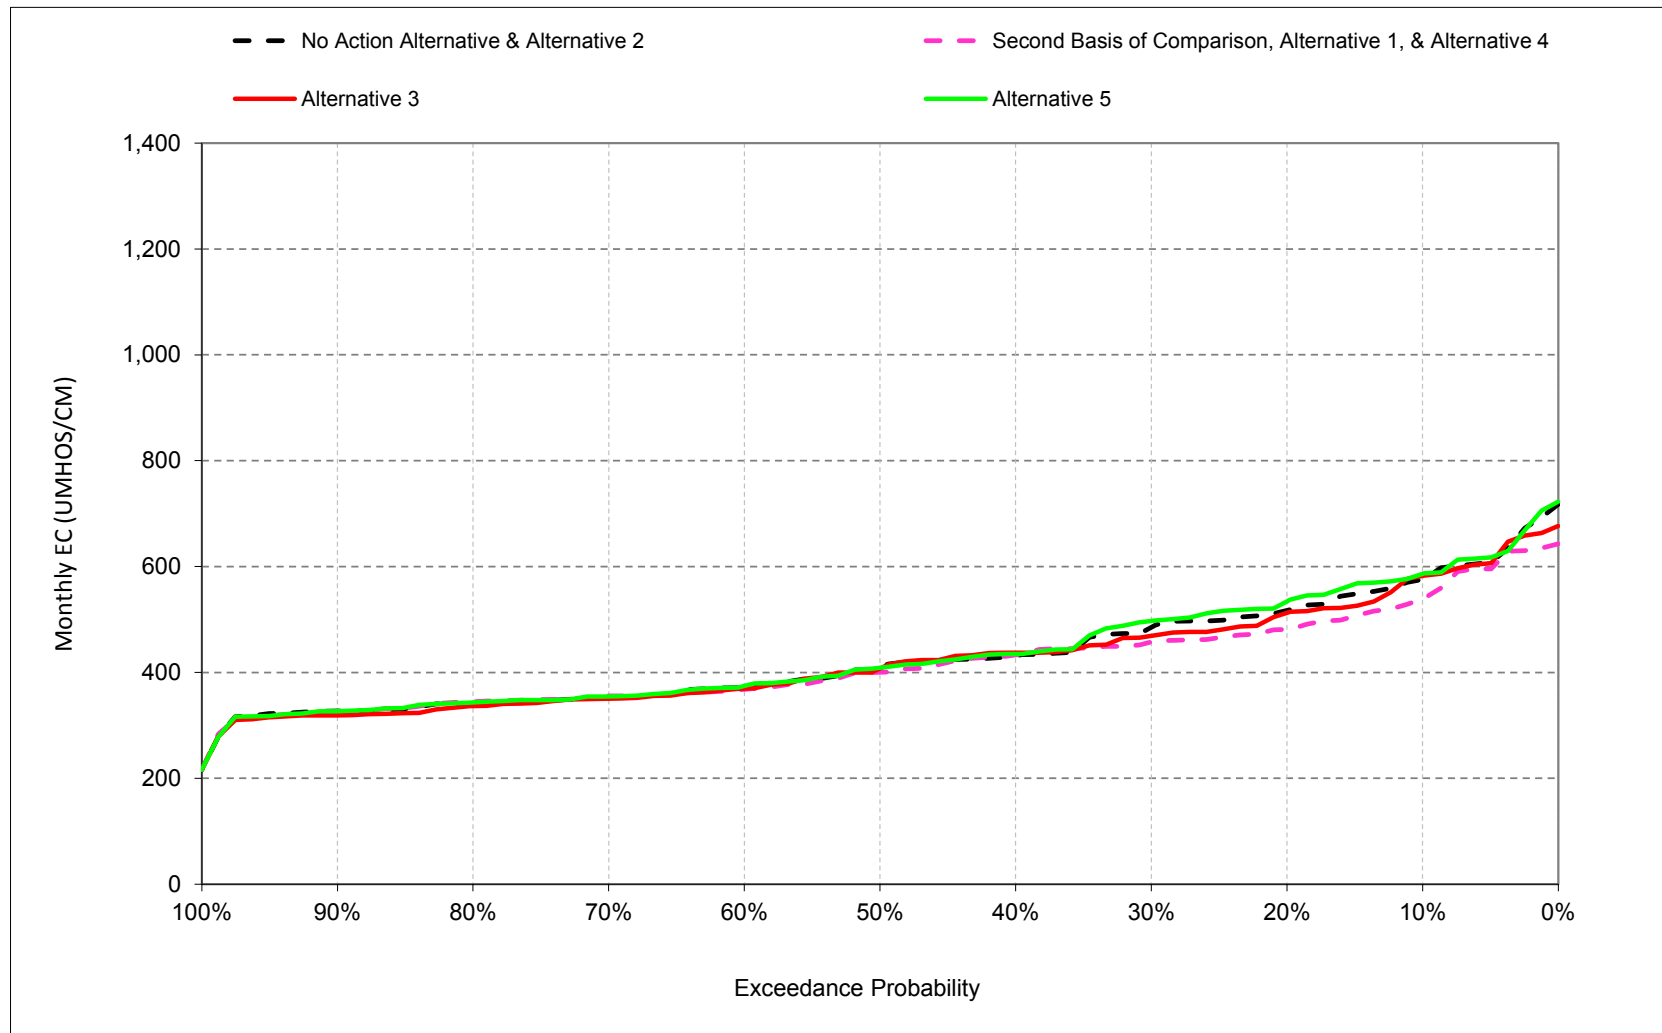

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.7.12. Jones Pumping Plant Salinity, Electrical Conductivity, September

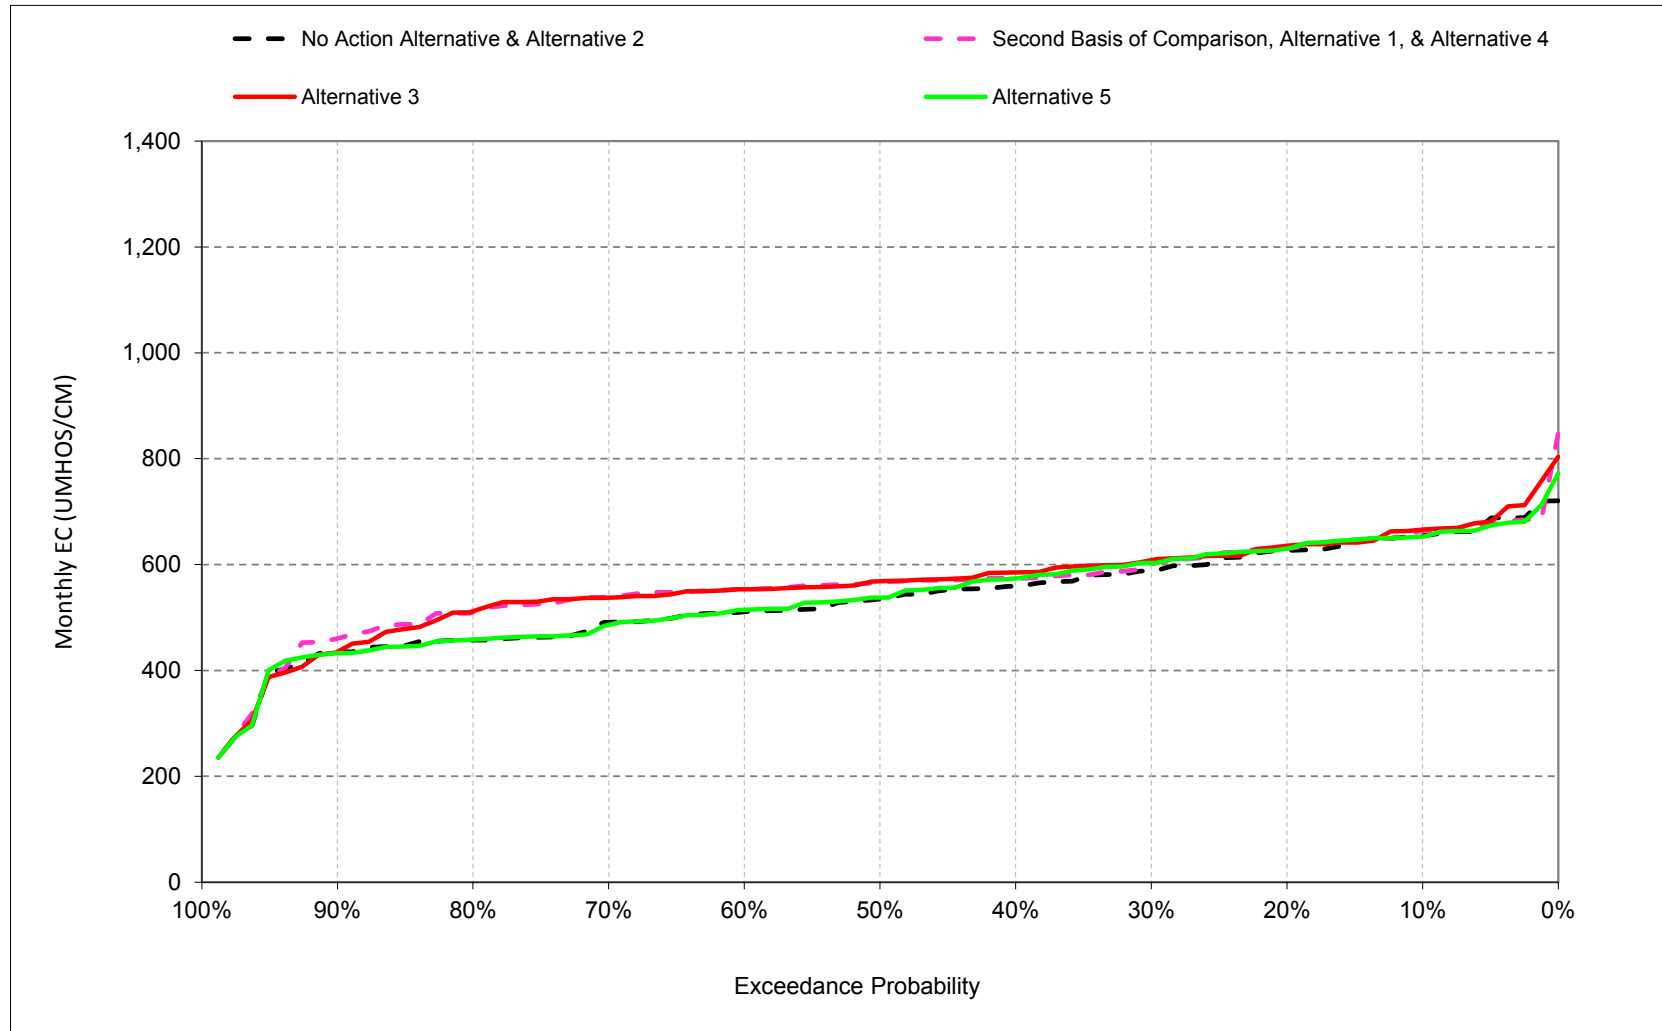

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.7.1. Jones Pumping Plant Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	734	805	837	801	816	786	617	561	484	442	576	655
20%	702	688	766	763	712	673	543	543	436	403	517	627
30%	680	637	715	704	688	616	476	498	409	386	485	588
40%	644	610	650	667	653	576	438	449	397	376	432	559
50%	608	545	532	639	604	530	371	397	390	361	411	535
60%	394	406	494	605	541	429	330	376	384	347	374	511
70%	380	367	454	571	484	366	312	362	371	344	353	491
80%	364	344	435	518	409	316	282	316	355	330	341	457
90%	356	334	423	452	326	288	231	205	335	311	327	436
Long Term												
Full Simulation Period ^b	536	529	590	629	583	518	404	410	396	374	430	536
Water Year Types ^c												
Wet (32%)	472	446	495	518	408	337	264	288	352	349	340	462
Above Normal (16%)	606	595	600	624	574	451	353	375	388	343	355	448
Below Normal (13%)	478	460	561	630	621	534	407	433	403	343	418	591
Dry (24%)	537	546	628	692	673	623	486	482	406	384	520	588
Critical (15%)	649	673	745	768	789	792	626	571	476	474	571	652
Alternative 1												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	755	807	831	822	759	665	525	456	450	427	539	664
20%	724	718	777	759	702	605	479	425	421	387	481	630
30%	708	678	747	733	637	544	417	402	394	369	458	601
40%	692	650	720	710	570	509	379	355	373	353	433	574
50%	678	635	703	682	542	475	358	344	363	345	400	568
60%	655	611	682	576	496	426	328	328	352	335	368	554
70%	637	587	626	510	442	375	309	316	342	330	356	542
80%	619	563	539	462	392	320	283	300	331	320	345	519
90%	546	476	431	432	324	295	233	204	298	301	326	469
Long Term												
Full Simulation Period ^b	657	630	668	627	541	478	372	348	372	363	418	563
Water Year Types ^c												
Wet (32%)	608	578	569	481	380	339	261	264	335	341	336	484
Above Normal (16%)	704	657	665	620	512	417	327	319	357	331	358	565
Below Normal (13%)	619	579	670	673	599	500	393	363	348	331	418	568
Dry (24%)	673	644	723	703	613	534	428	394	385	359	479	598
Critical (15%)	724	734	796	779	750	735	545	471	465	481	559	665
Alternative 1 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	21	1	-6	21	-57	-122	-92	-105	-34	-15	-37	9
20%	22	30	11	-4	-10	-68	-63	-119	-15	-16	-36	4
30%	29	42	32	29	-51	-72	-59	-95	-15	-17	-27	13
40%	49	41	70	43	-83	-67	-59	-94	-24	-23	1	15
50%	70	90	171	44	-62	-55	-13	-53	-28	-16	-11	33
60%	261	205	188	-29	-45	-2	-3	-48	-32	-12	-6	43
70%	257	220	172	-62	-42	9	-3	-46	-29	-14	2	51
80%	255	219	104	-56	-17	4	1	-16	-25	-10	4	62
90%	190	143	8	-20	-1	7	2	-1	-37	-10	-1	33
Long Term												
Full Simulation Period ^b	122	101	79	-2	-42	-40	-33	-62	-24	-11	-13	27
Water Year Types ^c												
Wet (32%)	136	132	73	-37	-28	1	-3	-24	-16	-8	-4	22
Above Normal (16%)	98	61	65	-4	-61	-34	-25	-56	-31	-13	3	117
Below Normal (13%)	141	120	109	43	-22	-34	-14	-70	-55	-12	0	-22
Dry (24%)	136	98	95	11	-59	-89	-58	-88	-21	-25	-41	10
Critical (15%)	75	61	51	11	-39	-58	-81	-99	-11	7	-12	13

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.7.2. Jones Pumping Plant Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	734	805	837	801	816	786	617	561	484	442	576	655
20%	702	688	766	763	712	673	543	543	436	403	517	627
30%	680	637	715	704	688	616	476	498	409	386	485	588
40%	644	610	650	667	653	576	438	449	397	376	432	559
50%	608	545	532	639	604	530	371	397	390	361	411	535
60%	394	406	494	605	541	429	330	376	384	347	374	511
70%	380	367	454	571	484	366	312	362	371	344	353	491
80%	364	344	435	518	409	316	282	316	355	330	341	457
90%	356	334	423	452	326	288	231	205	335	311	327	436
Long Term												
Full Simulation Period ^b	536	529	590	629	583	518	404	410	396	374	430	536
Water Year Types ^c												
Wet (32%)	472	446	495	518	408	337	264	288	352	349	340	462
Above Normal (16%)	606	595	600	624	574	451	353	375	388	343	355	448
Below Normal (13%)	478	460	561	630	621	534	407	433	403	343	418	591
Dry (24%)	537	546	628	692	673	623	486	482	406	384	520	588
Critical (15%)	649	673	745	768	789	792	626	571	476	474	571	652

Alternative 3												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	754	802	832	807	811	776	617	576	423	447	582	666
20%	724	713	776	778	734	673	524	526	399	403	513	635
30%	711	672	741	747	683	612	476	476	381	384	469	612
40%	689	647	729	720	643	567	397	428	369	367	437	586
50%	664	631	707	702	594	501	367	369	355	356	407	569
60%	651	619	680	638	525	441	321	348	346	349	370	553
70%	633	602	631	597	458	372	308	330	334	340	351	539
80%	614	566	539	499	390	314	275	306	321	331	337	522
90%	546	492	453	439	305	289	231	205	297	307	319	451
Long Term												
Full Simulation Period ^b	656	637	672	647	574	511	397	399	362	374	424	564
Water Year Types ^c												
Wet (32%)	603	585	580	517	388	337	260	275	328	349	332	473
Above Normal (16%)	715	676	678	661	551	431	335	344	340	342	357	570
Below Normal (13%)	618	576	674	685	615	521	408	431	350	350	428	603
Dry (24%)	665	655	729	720	675	613	477	469	368	378	501	596
Critical (15%)	729	734	771	760	796	798	620	578	460	477	566	664

Alternative 3 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	20	-3	-5	6	-5	-10	0	15	-61	4	7	11
20%	22	25	10	16	21	0	-19	-17	-37	0	-5	9
30%	31	35	26	44	-5	-4	0	-22	-27	-2	-16	23
40%	45	38	78	53	-10	-9	-41	-21	-28	-8	5	26
50%	56	86	175	63	-10	-30	-4	-29	-35	-4	-4	34
60%	257	213	186	33	-16	13	-10	-28	-37	2	-4	42
70%	252	235	177	25	-25	6	-4	-32	-37	-4	-3	48
80%	250	222	104	-19	-18	-2	-8	-10	-35	1	-5	64
90%	190	159	30	-13	-21	1	0	0	-38	-4	-8	15
Long Term												
Full Simulation Period ^b	121	108	83	19	-10	-7	-7	-11	-34	0	-6	28
Water Year Types ^c												
Wet (32%)	131	139	85	-2	-21	-1	-5	-13	-24	1	-8	11
Above Normal (16%)	109	80	78	37	-23	-20	-18	-31	-48	-2	2	122
Below Normal (13%)	140	116	113	55	-6	-14	1	-2	-53	7	11	13
Dry (24%)	128	109	101	29	2	-10	-10	-12	-38	-6	-18	8
Critical (15%)	80	61	26	-7	7	5	-5	7	-16	4	-5	12

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.7.3. Jones Pumping Plant Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	734	805	837	801	816	786	617	561	484	442	576	655
20%	702	688	766	763	712	673	543	543	436	403	517	627
30%	680	637	715	704	688	616	476	498	409	386	485	588
40%	644	610	650	667	653	576	438	449	397	376	432	559
50%	608	545	532	639	604	530	371	397	390	361	411	535
60%	394	406	494	605	541	429	330	376	384	347	374	511
70%	380	367	454	571	484	366	312	362	371	344	353	491
80%	364	344	435	518	409	316	282	316	355	330	341	457
90%	356	334	423	452	326	288	231	205	335	311	327	436
Long Term												
Full Simulation Period ^b	536	529	590	629	583	518	404	410	396	374	430	536
Water Year Types ^c												
Wet (32%)	472	446	495	518	408	337	264	288	352	349	340	462
Above Normal (16%)	606	595	600	624	574	451	353	375	388	343	355	448
Below Normal (13%)	478	460	561	630	621	534	407	433	403	343	418	591
Dry (24%)	537	546	628	692	673	623	486	482	406	384	520	588
Critical (15%)	649	673	745	768	789	792	626	571	476	474	571	652
Alternative 5												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	761	800	832	802	816	786	613	547	531	453	586	653
20%	708	710	758	763	718	673	546	534	459	408	534	630
30%	671	641	722	702	689	616	462	481	434	391	497	603
40%	651	613	656	666	653	576	425	431	417	381	435	574
50%	605	553	533	638	604	530	378	393	400	366	409	538
60%	397	408	495	606	541	429	330	366	391	354	375	515
70%	383	361	457	574	484	369	312	357	378	345	355	486
80%	364	345	429	519	409	317	282	316	359	331	343	458
90%	358	334	423	452	325	288	233	205	345	312	327	433
Long Term												
Full Simulation Period ^b	540	530	589	630	584	519	401	404	411	376	435	540
Water Year Types ^c												
Wet (32%)	474	449	497	518	408	339	265	283	352	350	341	462
Above Normal (16%)	617	593	596	623	574	451	350	364	390	344	355	448
Below Normal (13%)	477	461	561	630	620	534	406	434	416	345	419	596
Dry (24%)	541	545	626	697	675	623	481	486	437	394	535	600
Critical (15%)	653	674	745	769	789	794	617	544	514	468	573	659
Alternative 5 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	27	-5	-5	1	0	0	-4	-14	47	11	10	-2
20%	6	22	-7	0	6	0	3	-9	23	5	17	4
30%	-8	5	8	-1	1	0	-14	-16	25	5	12	15
40%	8	3	6	-1	0	0	-13	-17	20	5	3	14
50%	-3	8	1	-1	0	0	7	-4	10	5	-2	3
60%	3	2	0	0	0	0	0	-10	8	7	1	4
70%	2	-6	3	3	0	3	0	-5	7	2	1	-5
80%	1	1	-6	0	0	1	-1	0	4	1	2	1
90%	2	0	0	0	0	0	2	0	10	1	0	-2
Long Term												
Full Simulation Period ^b	4	1	0	1	0	1	-3	-6	15	2	4	5
Water Year Types ^c												
Wet (32%)	2	4	2	0	0	2	0	-5	0	1	1	0
Above Normal (16%)	11	-3	-5	-1	0	0	-3	-11	2	0	0	0
Below Normal (13%)	0	2	0	0	-1	0	-1	1	12	3	1	5
Dry (24%)	5	-1	-1	5	2	0	-5	4	31	10	15	12
Critical (15%)	4	1	1	1	0	1	-9	-26	38	-5	2	7

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.7.4. Jones Pumping Plant Salinity, Monthly EC

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	755	807	831	822	759	665	525	456	450	427	539	664
20%	724	718	777	759	702	605	479	425	421	387	481	630
30%	708	678	747	733	637	544	417	402	394	369	458	601
40%	692	650	720	710	570	509	379	355	373	353	433	574
50%	678	635	703	682	542	475	358	344	363	345	400	568
60%	655	611	682	576	496	426	328	328	352	335	368	554
70%	637	587	626	510	442	375	309	316	342	330	356	542
80%	619	563	539	462	392	320	283	300	331	320	345	519
90%	546	476	431	432	324	295	233	204	298	301	326	469
Long Term												
Full Simulation Period ^b	657	630	668	627	541	478	372	348	372	363	418	563
Water Year Types ^c												
Wet (32%)	608	578	569	481	380	339	261	264	335	341	336	484
Above Normal (16%)	704	657	665	620	512	417	327	319	357	331	358	565
Below Normal (13%)	619	579	670	673	599	500	393	363	348	331	418	568
Dry (24%)	673	644	723	703	613	534	428	394	385	359	479	598
Critical (15%)	724	734	796	779	750	735	545	471	465	481	559	665

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance ^a												
10%	734	805	837	801	816	786	617	561	484	442	576	655
20%	702	688	766	763	712	673	543	543	436	403	517	627
30%	680	637	715	704	688	616	476	498	409	386	485	588
40%	644	610	650	667	653	576	438	449	397	376	432	559
50%	608	545	532	639	604	530	371	397	390	361	411	535
60%	394	406	494	605	541	429	330	376	384	347	374	511
70%	380	367	454	571	484	366	312	362	371	344	353	491
80%	364	344	435	518	409	316	282	316	355	330	341	457
90%	356	334	423	452	326	288	231	205	335	311	327	436
Long Term												
Full Simulation Period ^b	536	529	590	629	583	518	404	410	396	374	430	536
Water Year Types ^c												
Wet (32%)	472	446	495	518	408	337	264	288	352	349	340	462
Above Normal (16%)	606	595	600	624	574	451	353	375	388	343	355	448
Below Normal (13%)	478	460	561	630	621	534	407	433	403	343	418	591
Dry (24%)	537	546	628	692	673	623	486	482	406	384	520	588
Critical (15%)	649	673	745	768	789	792	626	571	476	474	571	652

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative minus Second Basis of Comparison												
Probability of Exceedance ^a												
10%	-21	-1	6	-21	57	122	92	105	34	15	37	-9
20%	-22	-30	-11	4	10	68	63	119	15	16	36	-4
30%	-29	-42	-32	-29	51	72	59	95	15	17	27	-13
40%	-49	-41	-70	-43	83	67	59	94	24	23	-1	-15
50%	-70	-90	-171	-44	62	55	13	53	28	16	11	-33
60%	-261	-205	-188	29	45	2	3	48	32	12	6	-43
70%	-257	-220	-172	62	42	-9	3	46	29	14	-2	-51
80%	-255	-219	-104	56	17	-4	-1	16	25	10	-4	-62
90%	-190	-143	-8	20	1	-7	-2	1	37	10	1	-33
Long Term												
Full Simulation Period ^b	-122	-101	-79	2	42	40	33	62	24	11	13	-27
Water Year Types ^c												
Wet (32%)	-136	-132	-73	37	28	-1	3	24	16	8	4	-22
Above Normal (16%)	-98	-61	-65	4	61	34	25	56	31	13	-3	-117
Below Normal (13%)	-141	-120	-109	-43	22	34	14	70	55	12	0	22
Dry (24%)	-136	-98	-95	-11	59	89	58	88	21	25	41	-10
Critical (15%)	-75	-61	-51	-11	39	58	81	99	11	-7	12	-13

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.7.5. Jones Pumping Plant Salinity, Monthly EC

Second Basis of Comparison												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	755	807	831	822	759	665	525	456	450	427	539	664
20%	724	718	777	759	702	605	479	425	421	387	481	630
30%	708	678	747	733	637	544	417	402	394	369	458	601
40%	692	650	720	710	570	509	379	355	373	353	433	574
50%	678	635	703	682	542	475	358	344	363	345	400	568
60%	655	611	682	576	496	426	328	328	352	335	368	554
70%	637	587	626	510	442	375	309	316	342	330	356	542
80%	619	563	539	462	392	320	283	300	331	320	345	519
90%	546	476	431	432	324	295	233	204	298	301	326	469
Long Term												
Full Simulation Period ^b	657	630	668	627	541	478	372	348	372	363	418	563
Water Year Types ^c												
Wet (32%)	608	578	569	481	380	339	261	264	335	341	336	484
Above Normal (16%)	704	657	665	620	512	417	327	319	357	331	358	565
Below Normal (13%)	619	579	670	673	599	500	393	363	348	331	418	568
Dry (24%)	673	644	723	703	613	534	428	394	385	359	479	598
Critical (15%)	724	734	796	779	750	735	545	471	465	481	559	665

Alternative 3

Alternative 3												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	754	802	832	807	811	776	617	576	423	447	582	666
20%	724	713	776	778	734	673	524	526	399	403	513	635
30%	711	672	741	747	683	612	476	476	381	384	469	612
40%	689	647	729	720	643	567	397	428	369	367	437	586
50%	664	631	707	702	594	501	367	369	355	356	407	569
60%	651	619	680	638	525	441	321	348	346	349	370	553
70%	633	602	631	597	458	372	308	330	334	340	351	539
80%	614	566	539	499	390	314	275	306	321	331	337	522
90%	546	492	453	439	305	289	231	205	297	307	319	451
Long Term												
Full Simulation Period ^b	656	637	672	647	574	511	397	399	362	374	424	564
Water Year Types ^c												
Wet (32%)	603	585	580	517	388	337	260	275	328	349	332	473
Above Normal (16%)	715	676	678	661	551	431	335	344	340	342	357	570
Below Normal (13%)	618	576	674	685	615	521	408	431	350	350	428	603
Dry (24%)	665	655	729	720	675	613	477	469	368	378	501	596
Critical (15%)	729	734	771	760	796	798	620	578	460	477	566	664

Alternative 3 minus Second Basis of Comparison

Alternative 3 minus Second Basis of Comparison												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-1	-5	1	-14	52	112	92	120	-27	20	43	2
20%	0	-5	-1	20	31	68	44	102	-22	15	31	5
30%	2	-6	-5	15	46	68	59	74	-13	15	11	11
40%	-3	-3	9	10	73	58	18	73	-4	14	4	12
50%	-13	-4	4	19	52	25	9	24	-7	12	7	1
60%	-4	8	-2	62	29	15	-7	20	-5	14	1	-1
70%	-4	15	5	87	16	-3	-1	14	-8	10	-5	-3
80%	-4	3	0	37	-1	-5	-8	6	-10	11	-8	3
90%	0	16	22	6	-19	-6	-2	2	-1	6	-7	-18
Long Term												
Full Simulation Period ^b	-1	7	4	21	32	33	26	51	-10	11	6	1
Water Year Types ^c												
Wet (32%)	-5	7	11	35	8	-2	-2	11	-7	8	-4	-11
Above Normal (16%)	11	19	13	41	38	14	7	25	-18	11	-1	4
Below Normal (13%)	-1	-3	4	12	15	21	15	68	3	19	10	35
Dry (24%)	-8	11	6	18	61	79	49	76	-17	19	23	-2
Critical (15%)	5	0	-25	-19	46	63	76	107	-5	-3	7	-1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.7.6. Jones Pumping Plant Salinity, Monthly EC

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	755	807	831	822	759	665	525	456	450	427	539	664
20%	724	718	777	759	702	605	479	425	421	387	481	630
30%	708	678	747	733	637	544	417	402	394	369	458	601
40%	692	650	720	710	570	509	379	355	373	353	433	574
50%	678	635	703	682	542	475	358	344	363	345	400	568
60%	655	611	682	576	496	426	328	328	352	335	368	554
70%	637	587	626	510	442	375	309	316	342	330	356	542
80%	619	563	539	462	392	320	283	300	331	320	345	519
90%	546	476	431	432	324	295	233	204	298	301	326	469
Long Term												
Full Simulation Period ^b	657	630	668	627	541	478	372	348	372	363	418	563
Water Year Types ^c												
Wet (32%)	608	578	569	481	380	339	261	264	335	341	336	484
Above Normal (16%)	704	657	665	620	512	417	327	319	357	331	358	565
Below Normal (13%)	619	579	670	673	599	500	393	363	348	331	418	568
Dry (24%)	673	644	723	703	613	534	428	394	385	359	479	598
Critical (15%)	724	734	796	779	750	735	545	471	465	481	559	665

Alternative 5

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	761	800	832	802	816	786	613	547	531	453	586	653
20%	708	710	758	763	718	673	546	534	459	408	534	630
30%	671	641	722	702	689	616	462	481	434	391	497	603
40%	651	613	656	666	653	576	425	431	417	381	435	574
50%	605	553	533	638	604	530	378	393	400	366	409	538
60%	397	408	495	606	541	429	330	366	391	354	375	515
70%	383	361	457	574	484	369	312	357	378	345	355	486
80%	364	345	429	519	409	317	282	316	359	331	343	458
90%	358	334	423	452	325	288	233	205	345	312	327	433
Long Term												
Full Simulation Period ^b	540	530	589	630	584	519	401	404	411	376	435	540
Water Year Types ^c												
Wet (32%)	474	449	497	518	408	339	265	283	352	350	341	462
Above Normal (16%)	617	593	596	623	574	451	350	364	390	344	355	448
Below Normal (13%)	477	461	561	630	620	534	406	434	416	345	419	596
Dry (24%)	541	545	626	697	675	623	481	486	437	394	535	600
Critical (15%)	653	674	745	769	789	794	617	544	514	468	573	659

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	6	-7	1	-20	57	122	88	91	81	26	47	-11
20%	-16	-8	-18	5	16	68	66	109	38	20	53	0
30%	-37	-37	-24	-31	52	72	46	79	40	22	40	2
40%	-41	-37	-64	-44	83	67	46	76	44	28	1	0
50%	-73	-81	-170	-45	62	55	20	49	37	21	9	-31
60%	-258	-203	-188	29	45	2	3	38	40	19	7	-40
70%	-255	-226	-170	65	42	-6	3	41	36	16	-1	-56
80%	-254	-219	-110	56	17	-2	-1	16	28	11	-1	-61
90%	-188	-142	-8	20	1	-7	0	1	47	11	1	-35
Long Term												
Full Simulation Period ^b	-118	-100	-79	4	42	40	30	56	39	14	17	-22
Water Year Types ^c												
Wet (32%)	-134	-129	-71	37	28	0	3	19	17	9	5	-22
Above Normal (16%)	-87	-64	-69	3	61	34	22	45	33	13	-3	-117
Below Normal (13%)	-142	-118	-109	-43	21	34	13	71	68	15	0	28
Dry (24%)	-132	-98	-96	-5	62	89	53	92	52	35	56	2
Critical (15%)	-71	-60	-51	-10	39	59	72	73	48	-12	14	-6

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 **B.8. Banks Pumping Plant Salinity**

Figure 6E.B.8.1. Banks Pumping Plant Salinity, Electrical Conductivity, October

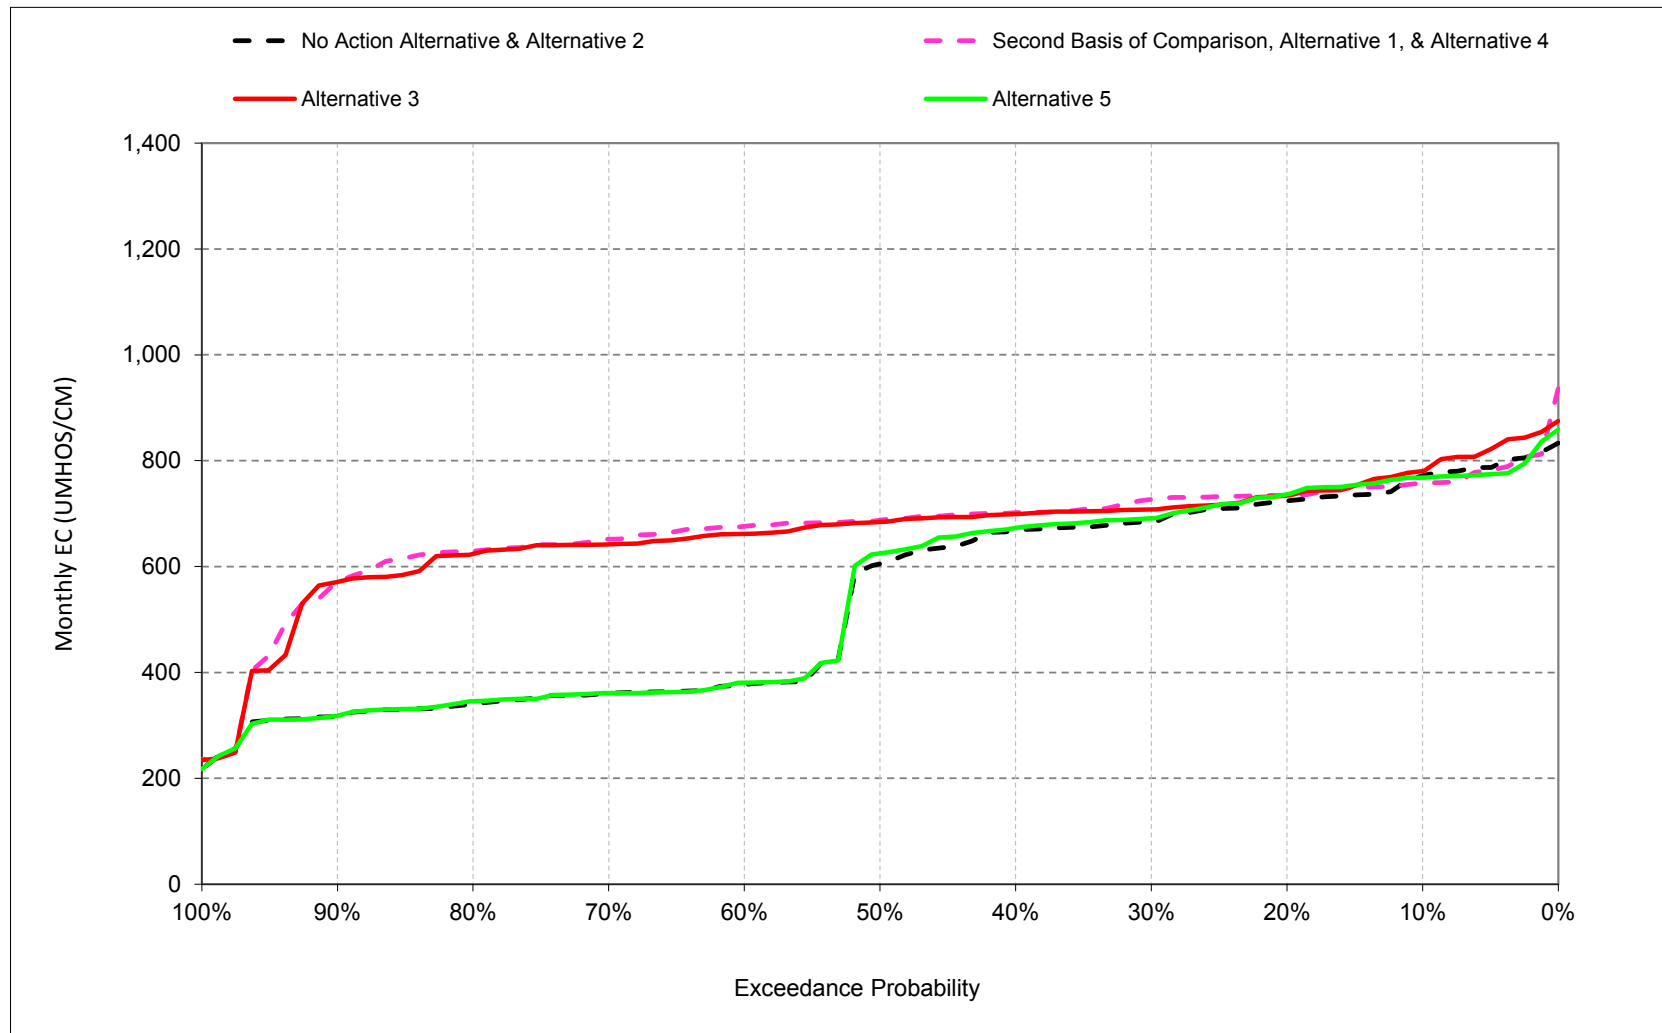


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.8.2. Banks Pumping Plant Salinity, Electrical Conductivity, November

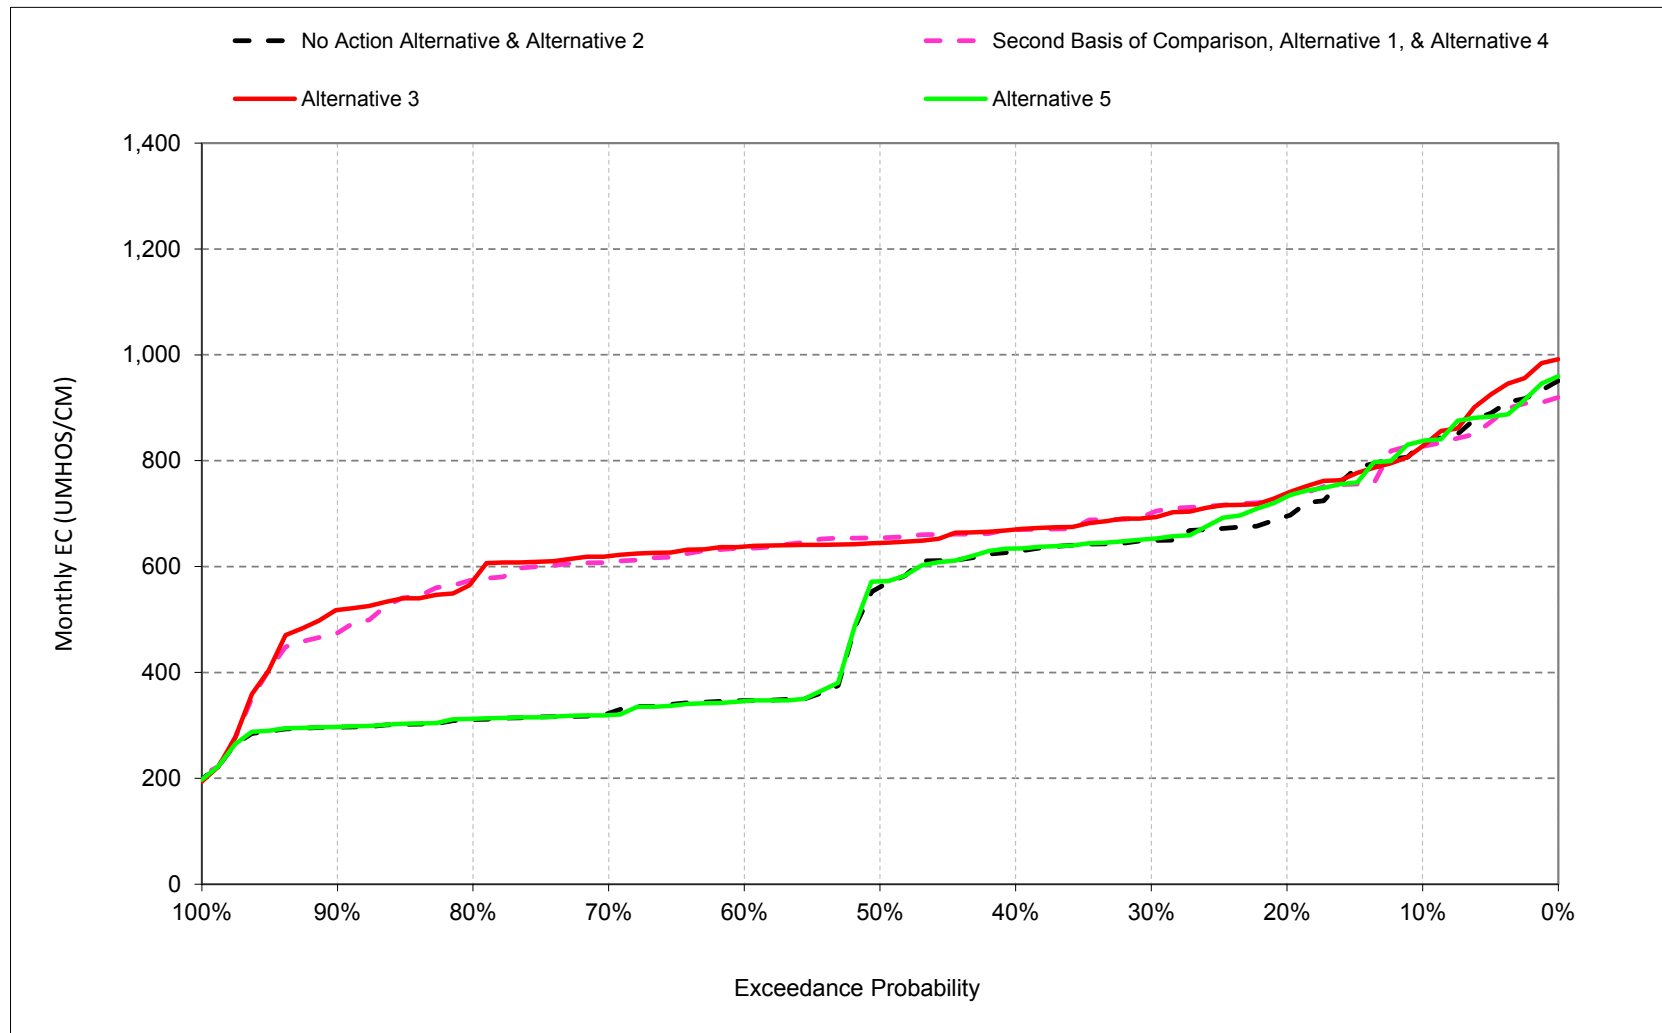


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.8.3. Banks Pumping Plant Salinity, Electrical Conductivity, December

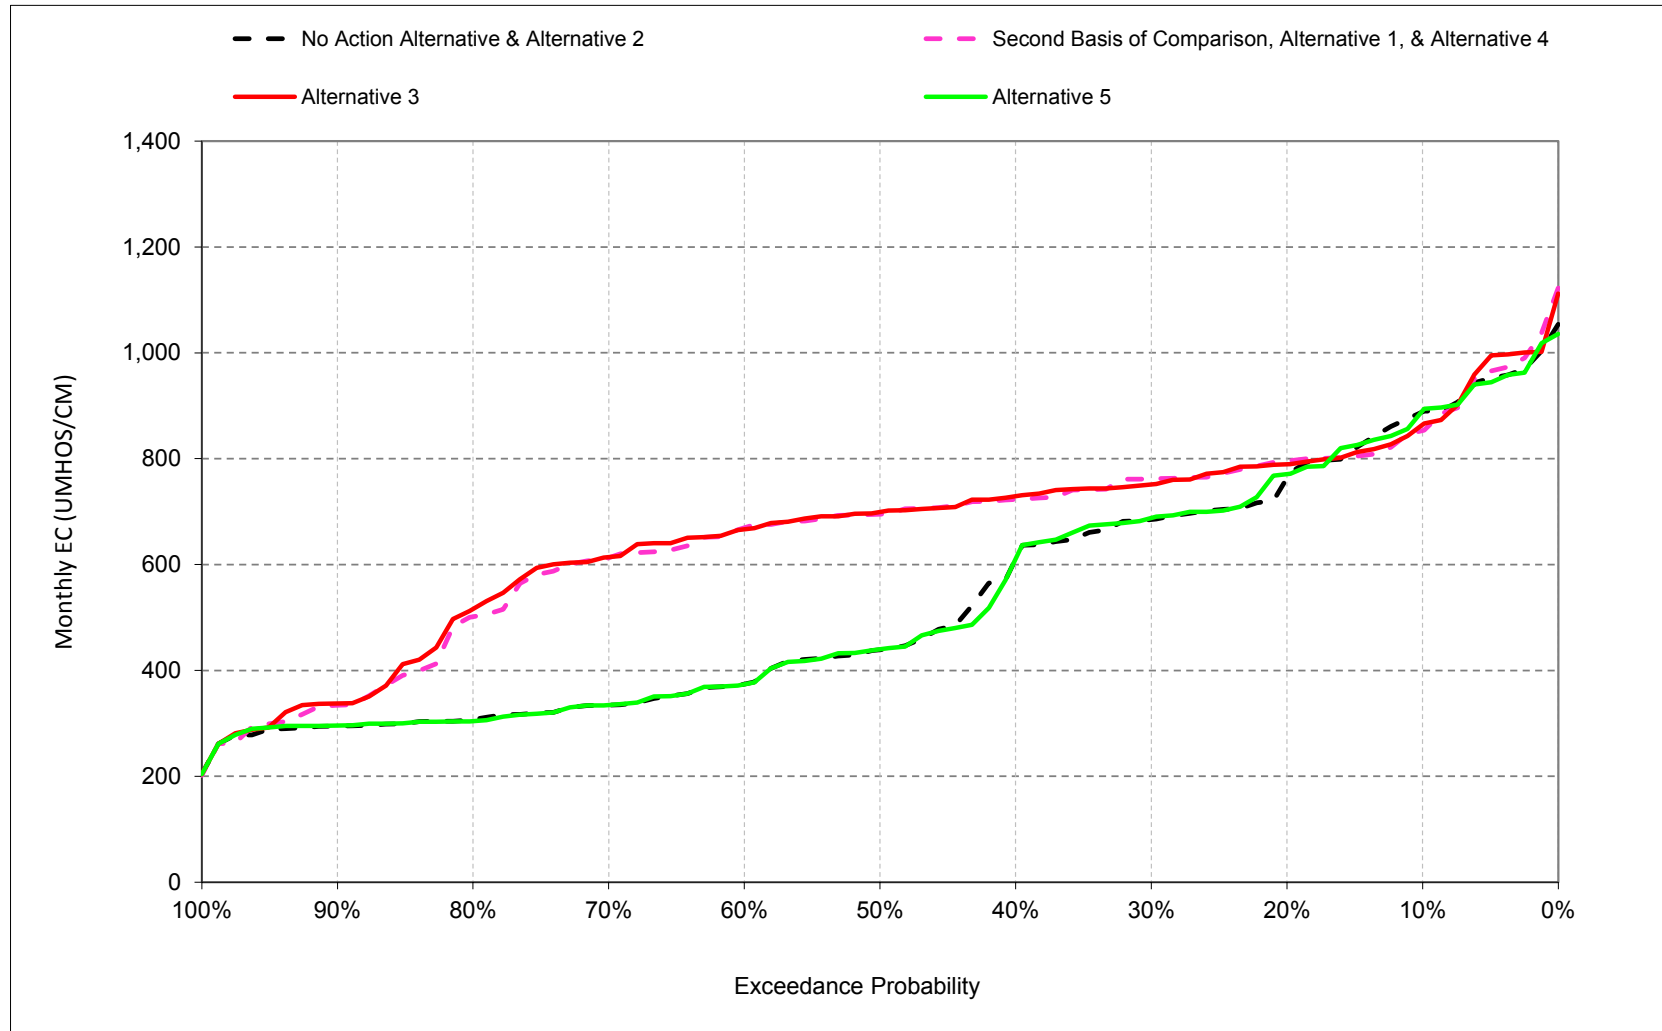


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.8.4. Banks Pumping Plant Salinity, Electrical Conductivity, January

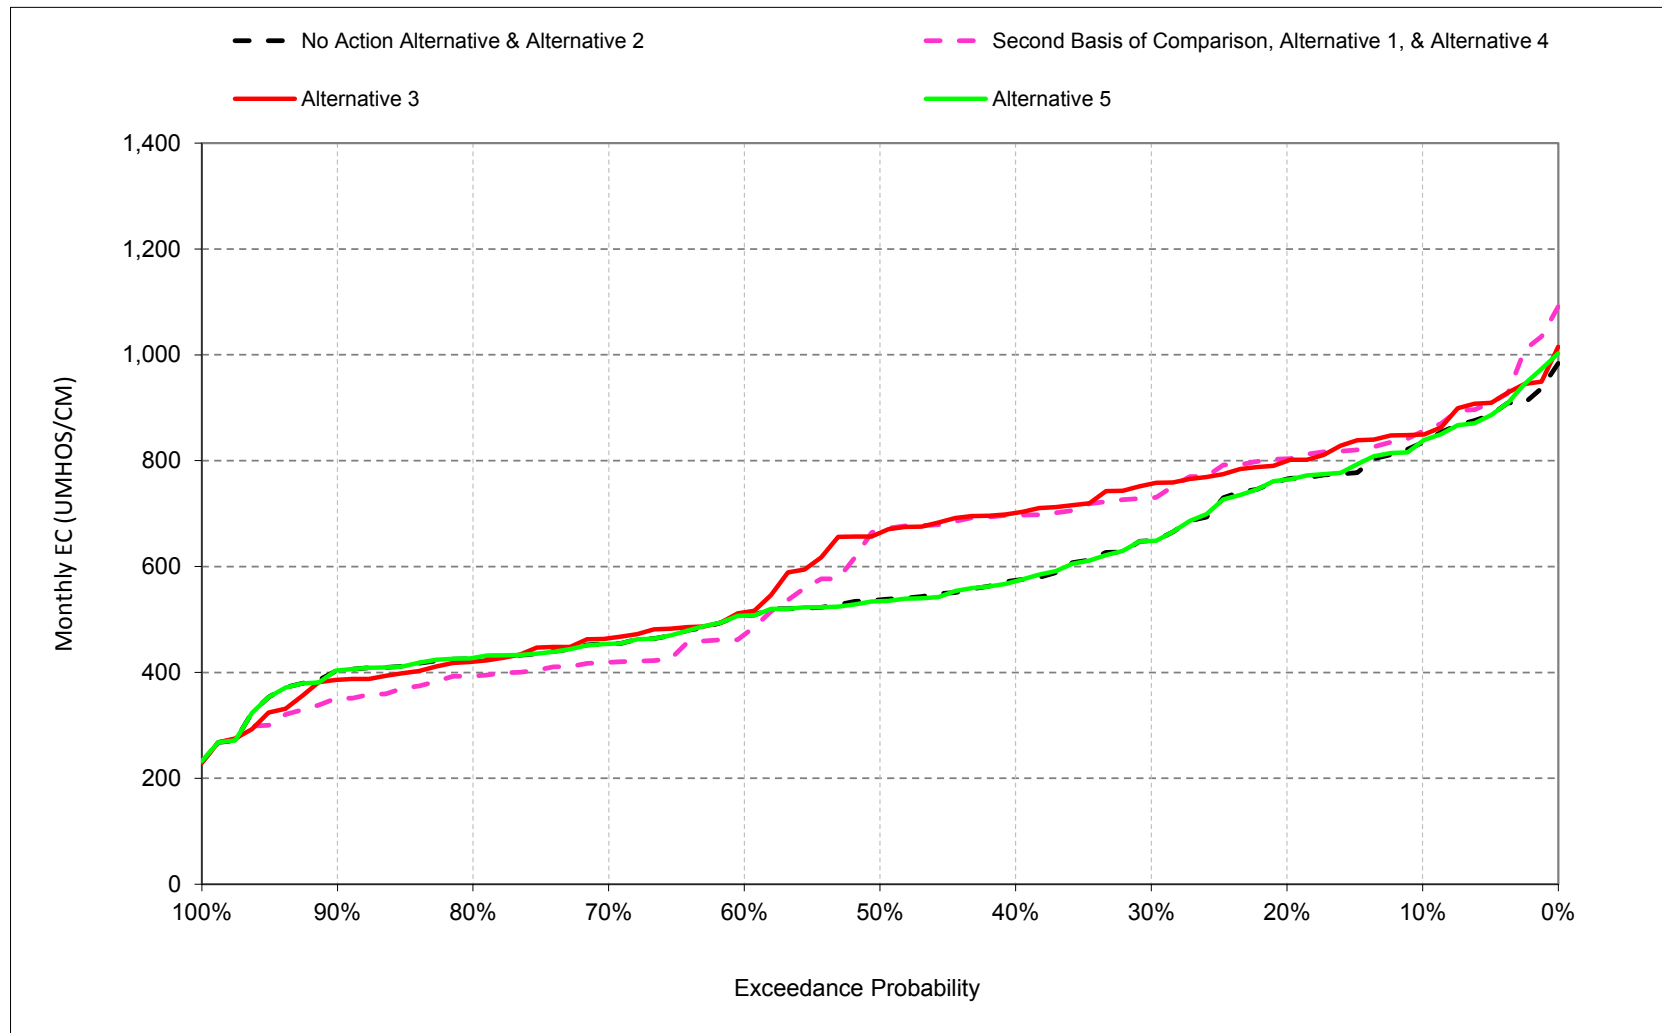


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.8.5. Banks Pumping Plant Salinity, Electrical Conductivity, February

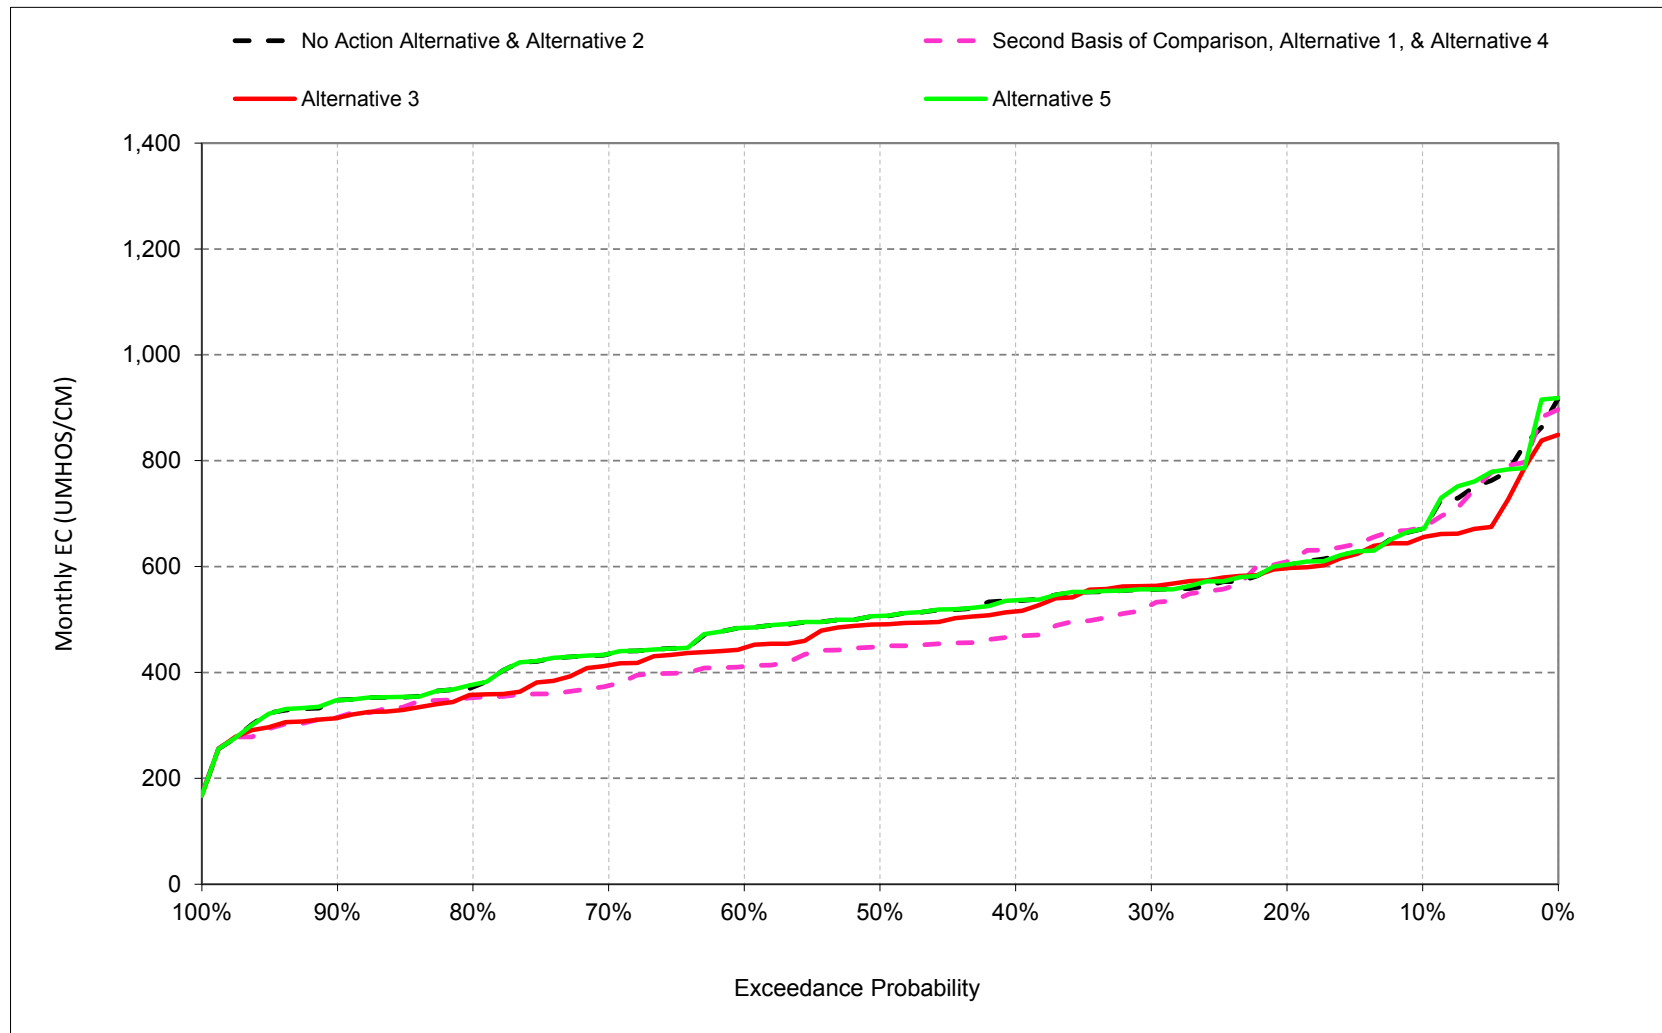


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.8.6. Banks Pumping Plant Salinity, Electrical Conductivity, March

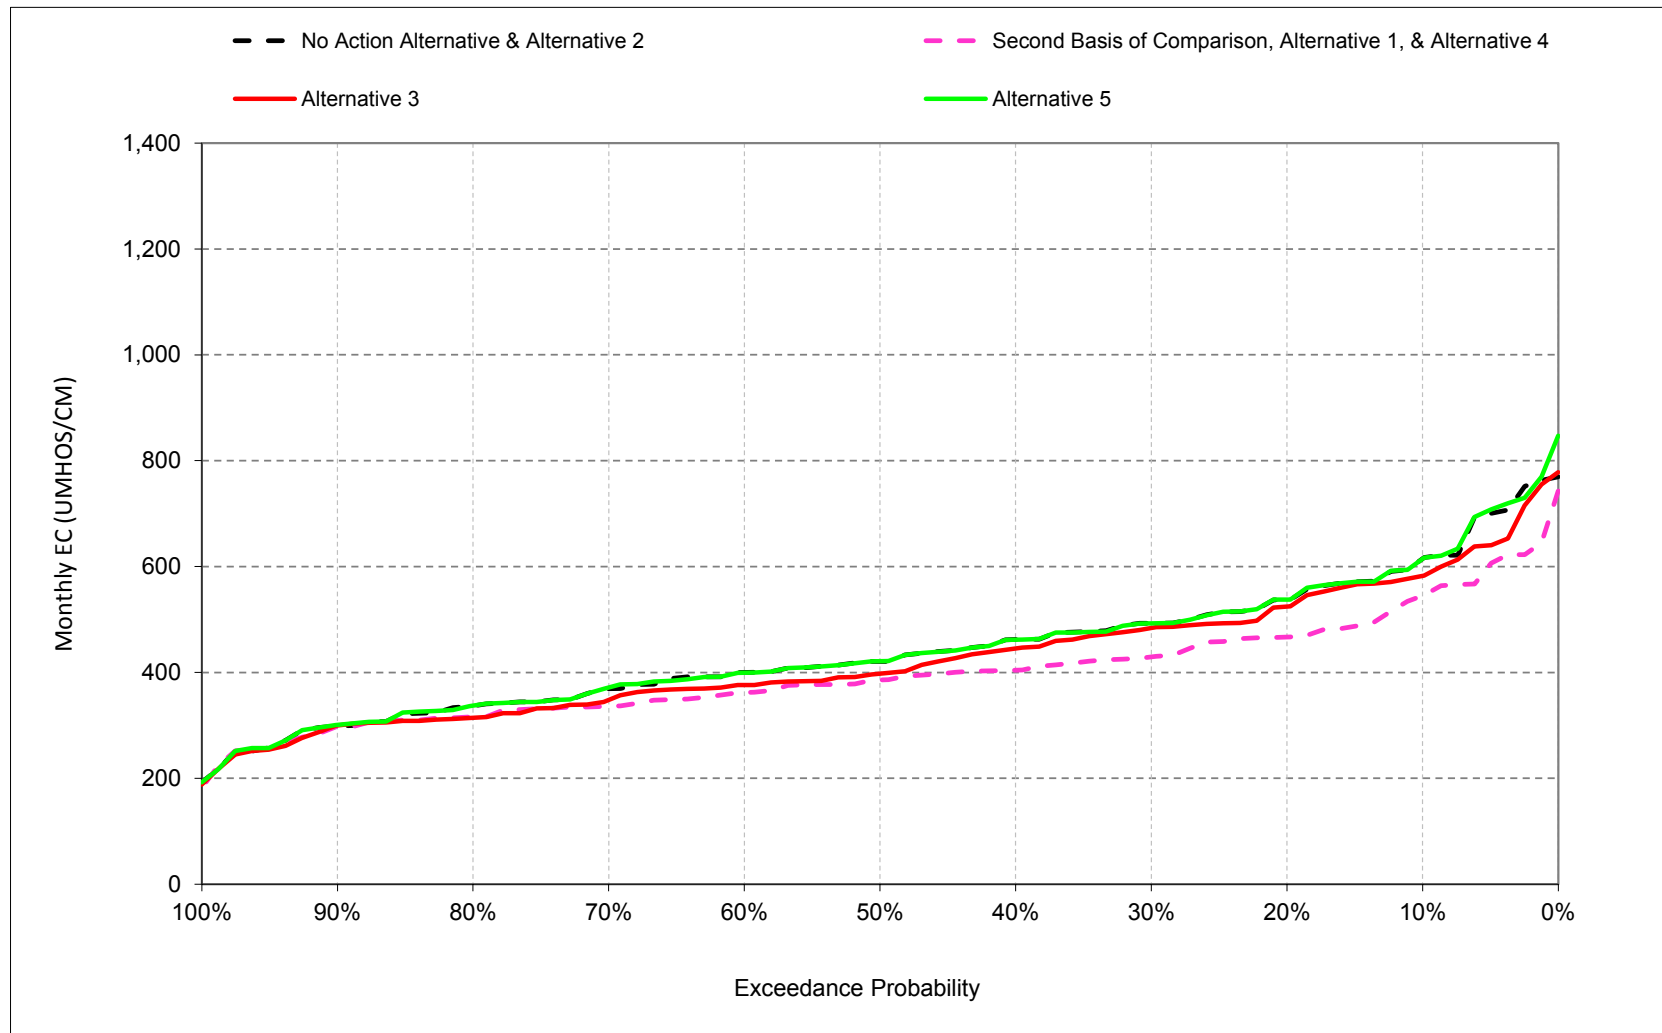


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.8.7. Banks Pumping Plant Salinity, Electrical Conductivity, April

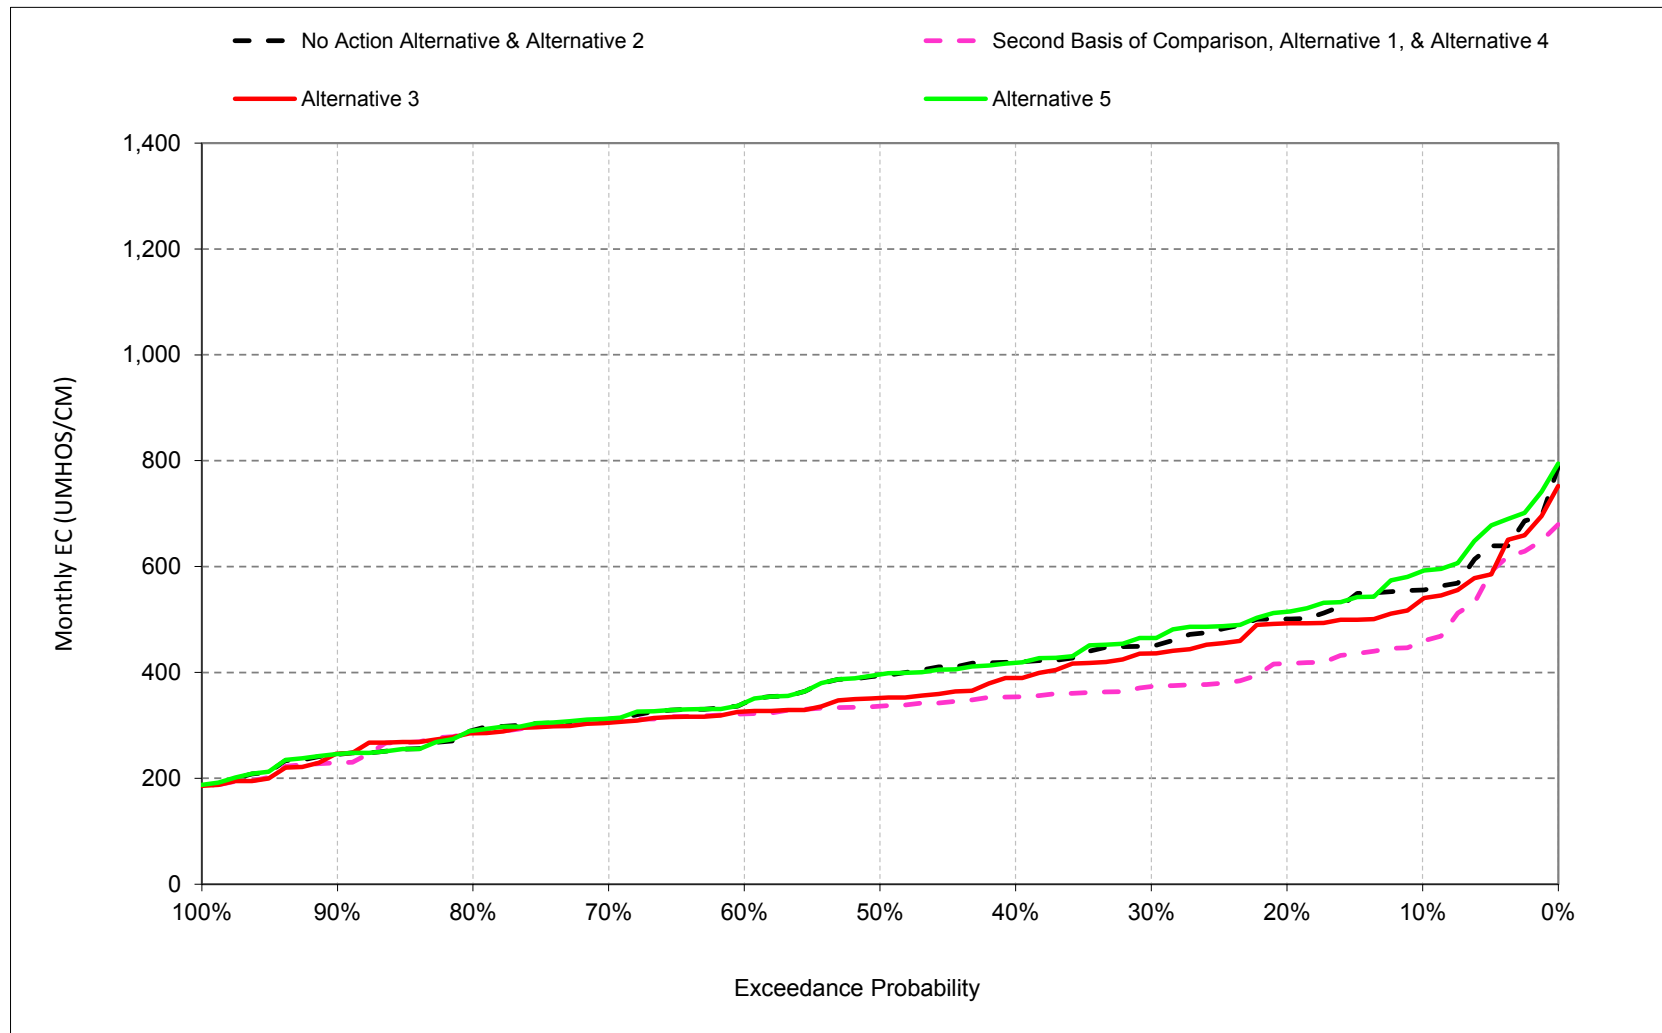


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.8.8. Banks Pumping Plant Salinity, Electrical Conductivity, May

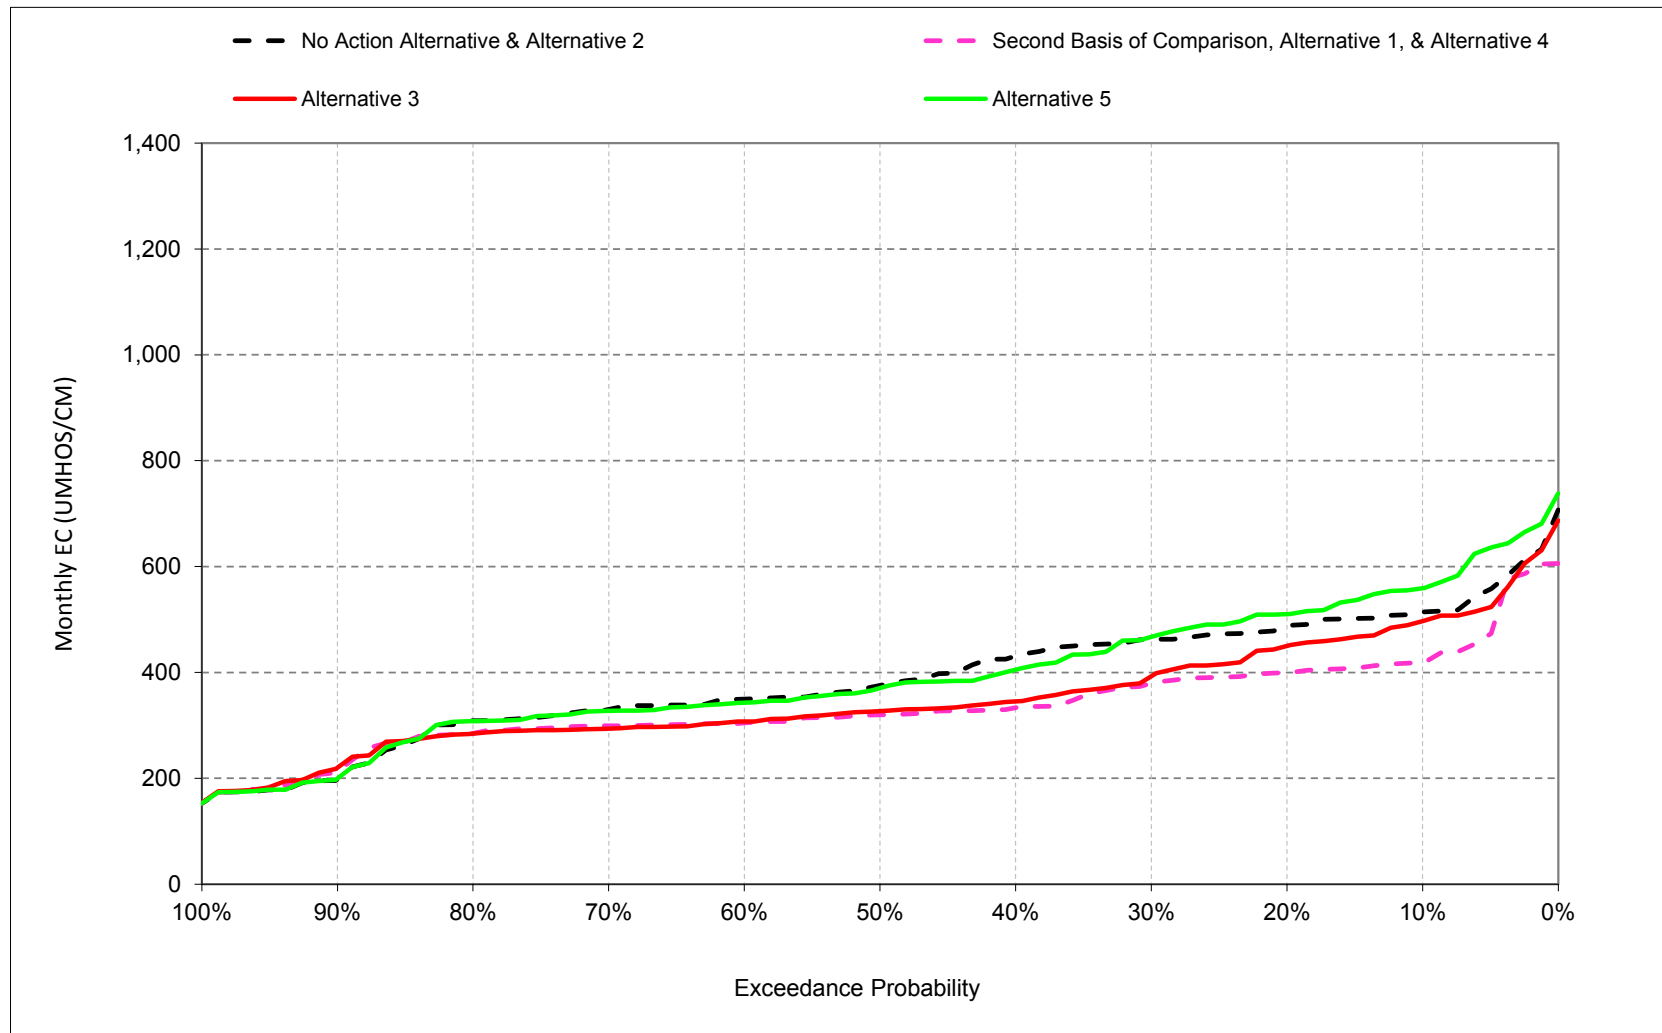


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.8.9. Banks Pumping Plant Salinity, Electrical Conductivity, June

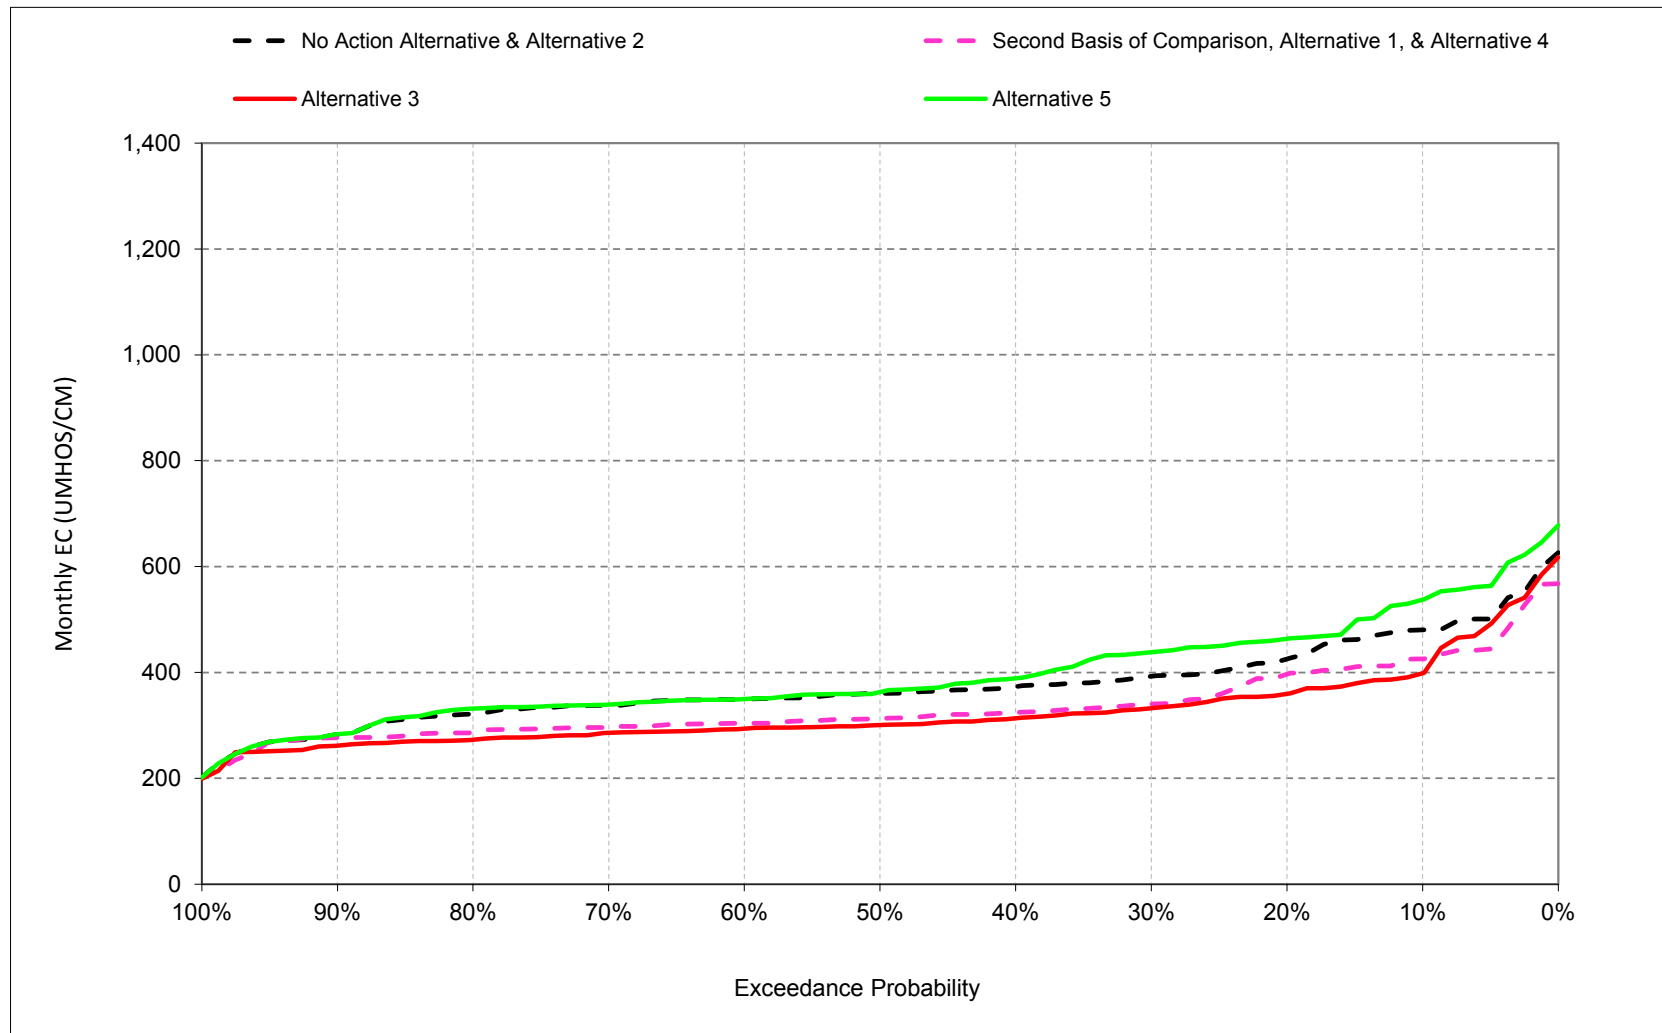


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.8.10. Banks Pumping Plant Salinity, Electrical Conductivity, July

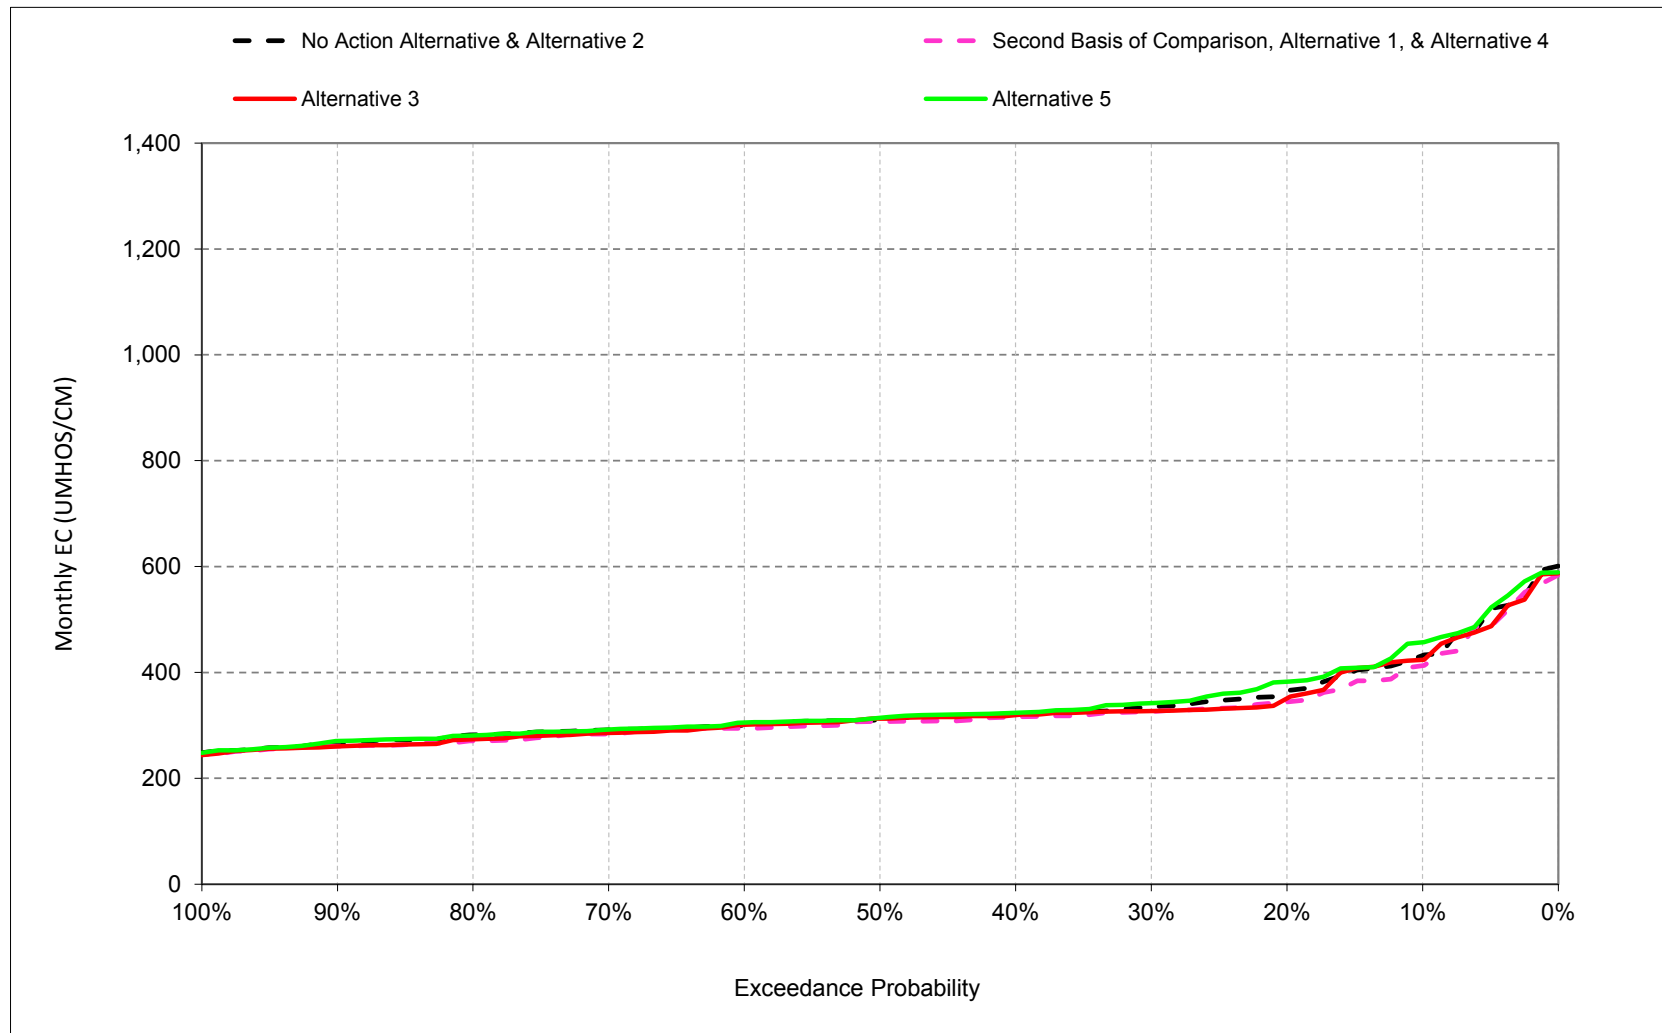


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.8.11. Banks Pumping Plant Salinity, Electrical Conductivity, August

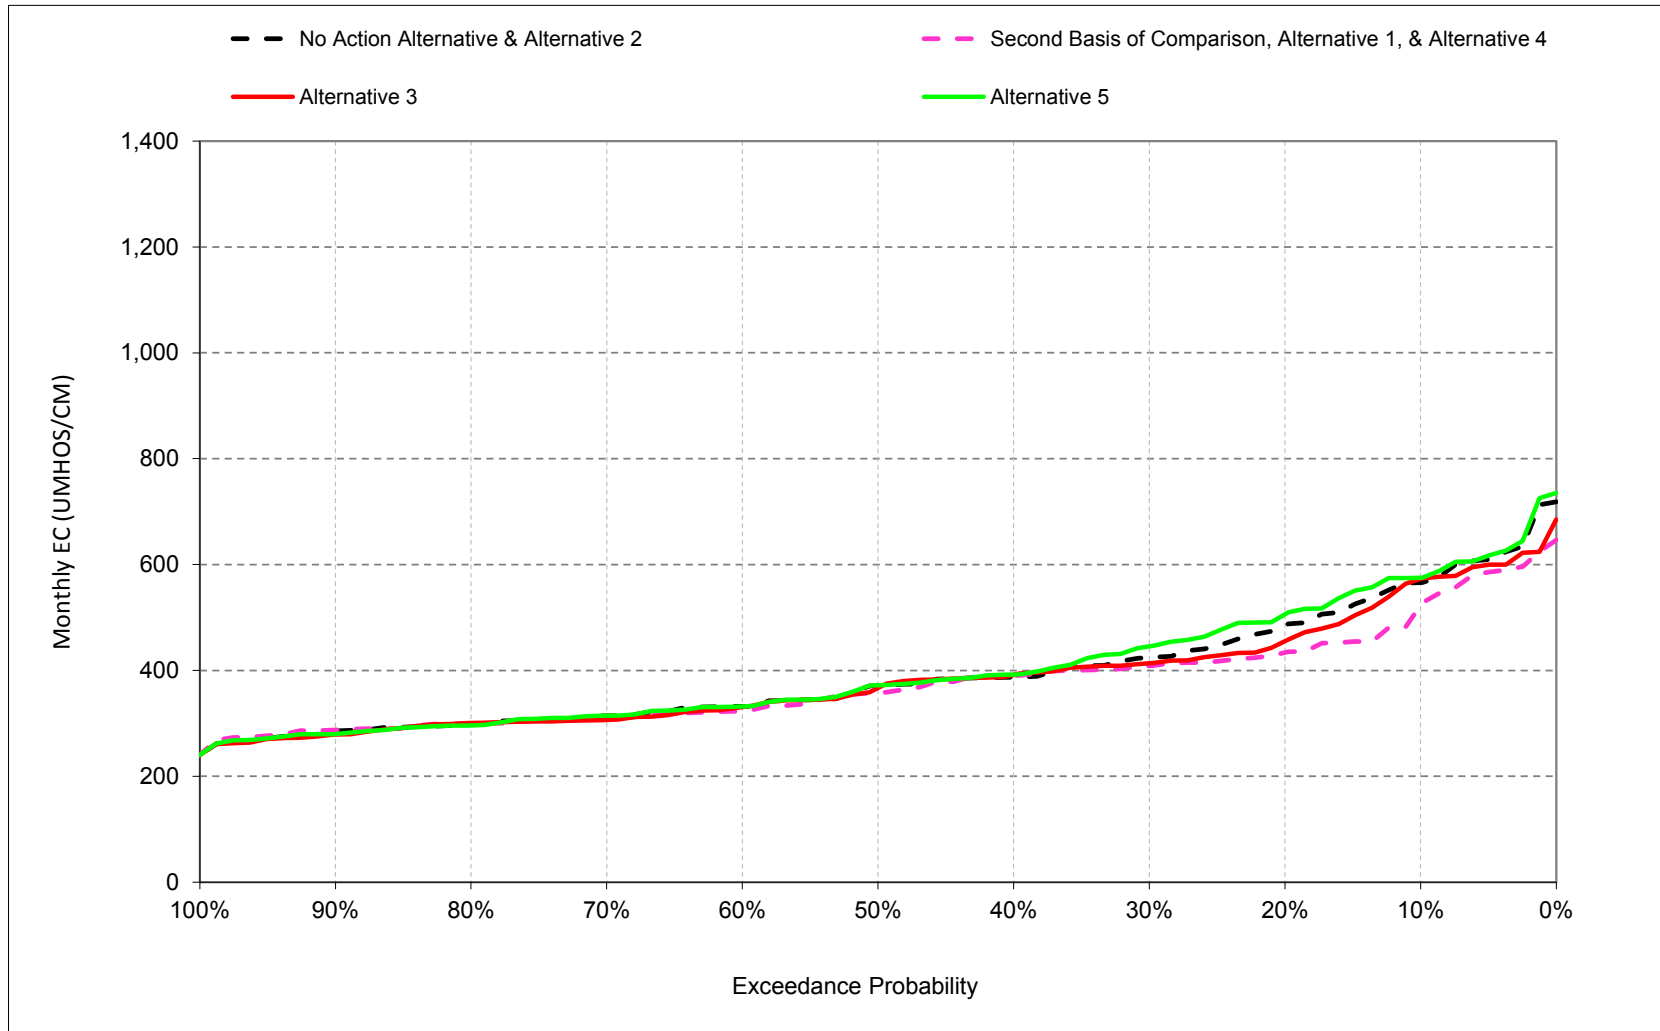

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.8.12. Banks Pumping Plant Salinity, Electrical Conductivity, September

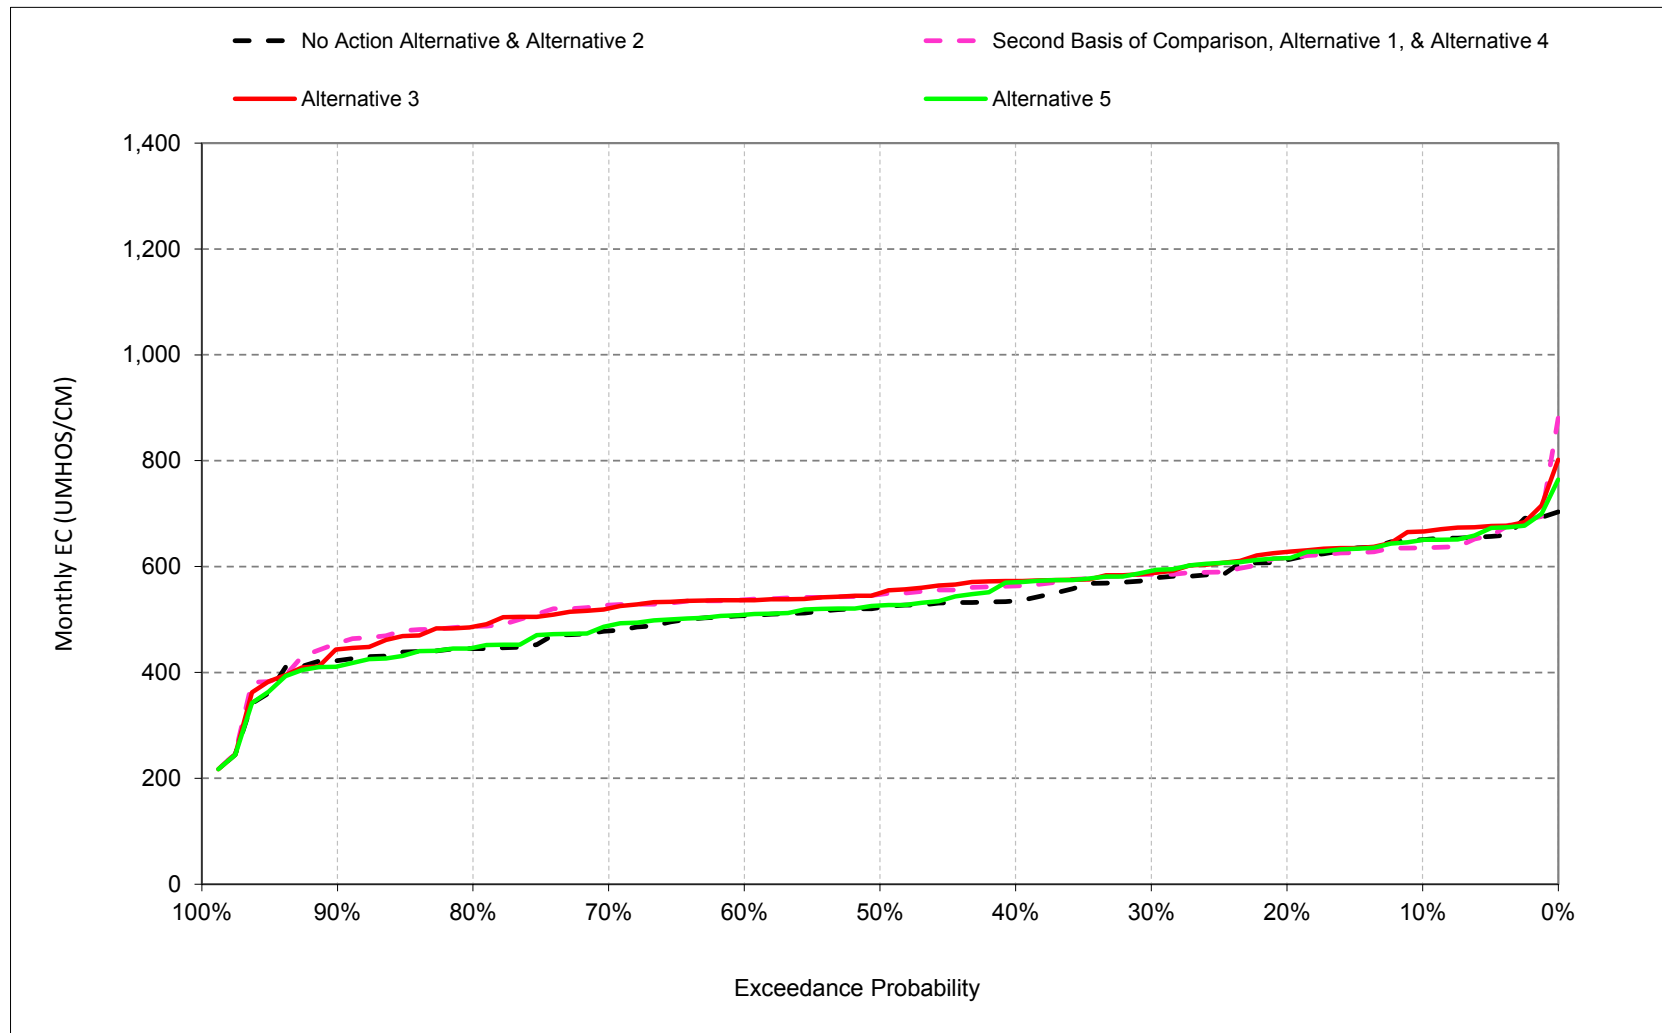

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.8.1. Banks Pumping Plant Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	771	833	888	834	671	615	556	514	481	432	566	651
20%	724	695	763	765	603	538	501	487	425	364	485	612
30%	684	649	685	649	557	493	451	462	393	335	424	577
40%	668	628	610	574	536	462	420	431	373	322	387	536
50%	605	561	439	537	506	421	394	376	361	311	371	523
60%	377	347	374	507	484	400	342	350	349	301	332	507
70%	360	323	334	454	435	369	312	330	338	292	314	478
80%	340	311	307	427	372	337	291	309	322	282	299	445
90%	317	296	295	403	348	299	245	198	283	268	286	422
Long Term												
Full Simulation Period ^b	534	521	532	575	508	442	398	386	374	333	394	525
Water Year Types ^c												
Wet (32%)	468	426	410	443	392	329	272	270	310	290	304	463
Above Normal (16%)	611	599	557	558	501	406	357	355	352	283	309	434
Below Normal (13%)	478	438	485	568	528	464	417	417	393	309	378	582
Dry (24%)	529	538	572	654	557	495	464	444	388	349	489	575
Critical (15%)	654	689	745	754	667	618	587	548	501	475	535	619
Alternative 1												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	758	827	853	856	674	545	459	419	426	413	523	635
20%	735	734	796	804	609	467	417	399	397	344	434	616
30%	727	701	762	730	528	429	374	379	340	326	409	585
40%	702	670	723	697	468	404	354	333	324	316	391	564
50%	688	655	695	668	449	386	336	320	313	307	358	549
60%	676	634	669	472	411	362	322	304	304	294	324	539
70%	652	609	613	419	375	336	306	299	297	284	310	528
80%	629	575	502	393	352	316	286	285	287	271	300	488
90%	571	474	334	351	315	297	229	213	277	261	287	464
Long Term												
Full Simulation Period ^b	668	646	658	603	475	400	352	336	335	324	378	548
Water Year Types ^c												
Wet (32%)	620	594	548	421	349	319	264	254	292	289	300	479
Above Normal (16%)	708	667	649	593	442	368	319	304	300	274	312	554
Below Normal (13%)	634	594	649	654	561	443	379	347	305	293	381	553
Dry (24%)	684	664	722	700	519	414	377	371	354	333	436	583
Critical (15%)	731	755	809	802	635	546	512	477	460	465	521	631
Alternative 1 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-14	-5	-35	21	3	-70	-97	-95	-55	-19	-43	-15
20%	10	39	33	38	6	-71	-84	-87	-29	-20	-51	3
30%	43	52	77	81	-29	-63	-77	-83	-52	-9	-16	8
40%	33	41	113	123	-68	-58	-66	-98	-49	-6	4	28
50%	83	93	256	131	-58	-35	-58	-56	-48	-4	-13	26
60%	299	288	295	-36	-73	-38	-20	-45	-45	-6	-8	32
70%	291	286	279	-35	-60	-33	-5	-31	-41	-8	-4	50
80%	289	264	194	-33	-20	-21	-4	-24	-35	-12	1	43
90%	254	178	39	-52	-32	-2	-16	15	-6	-7	1	42
Long Term												
Full Simulation Period ^b	134	125	126	28	-33	-43	-46	-51	-40	-9	-16	24
Water Year Types ^c												
Wet (32%)	152	168	137	-22	-43	-11	-8	-16	-18	-1	-5	15
Above Normal (16%)	97	69	92	35	-59	-38	-38	-51	-52	-9	2	120
Below Normal (13%)	157	156	164	86	33	-21	-38	-70	-88	-17	3	-29
Dry (24%)	155	126	149	46	-38	-81	-87	-72	-34	-16	-53	8
Critical (15%)	78	66	64	48	-32	-72	-76	-70	-40	-10	-14	11
<p>a Exceedance probability is defined as the probability a given value will be exceeded in any one year.</p> <p>b Based on the 82-year simulation period.</p> <p>c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.</p> <p>Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.</p>												

Table 6E.B.8.2. Banks Pumping Plant Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	771	833	888	834	671	615	556	514	481	432	566	651
20%	724	695	763	765	603	538	501	487	425	364	485	612
30%	684	649	685	649	557	493	451	462	393	335	424	577
40%	668	628	610	574	536	462	420	431	373	322	387	536
50%	605	561	439	537	506	421	394	376	361	311	371	523
60%	377	347	374	507	484	400	342	350	349	301	332	507
70%	360	323	334	454	435	369	312	330	338	292	314	478
80%	340	311	307	427	372	337	291	309	322	282	299	445
90%	317	296	295	403	348	299	245	198	283	268	286	422
Long Term												
Full Simulation Period ^b	534	521	532	575	508	442	398	386	374	333	394	525
Water Year Types ^c												
Wet (32%)	468	426	410	443	392	329	272	270	310	290	304	463
Above Normal (16%)	611	599	557	558	501	406	357	355	352	283	309	434
Below Normal (13%)	478	438	485	568	528	464	417	417	393	309	378	582
Dry (24%)	529	538	572	654	557	495	464	444	388	349	489	575
Critical (15%)	654	689	745	754	667	618	587	548	501	475	535	619

Alternative 3												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	780	827	864	849	655	582	538	497	398	424	573	666
20%	734	739	790	799	597	525	493	450	360	351	455	628
30%	708	693	751	756	563	484	436	393	333	327	413	591
40%	699	670	729	701	515	445	390	345	313	319	392	573
50%	684	644	699	664	491	398	352	327	301	313	367	556
60%	662	638	667	514	447	376	326	308	294	301	331	537
70%	642	620	614	465	414	348	305	294	286	286	307	527
80%	624	573	516	420	358	314	285	285	273	274	301	494
90%	571	518	338	386	314	300	247	220	261	260	279	446
Long Term												
Full Simulation Period ^b	665	654	662	618	487	426	379	351	325	328	386	551
Water Year Types ^c												
Wet (32%)	615	600	561	459	364	318	267	255	275	287	298	468
Above Normal (16%)	718	690	662	631	482	379	325	303	286	275	310	560
Below Normal (13%)	634	588	650	676	534	447	396	372	318	310	392	598
Dry (24%)	671	674	729	713	543	479	437	393	332	344	465	581
Critical (15%)	732	759	783	738	625	603	570	524	468	463	522	630

Alternative 3 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	9	-6	-24	15	-16	-33	-18	-17	-82	-8	7	15
20%	10	43	26	34	-6	-13	-8	-37	-66	-13	-30	15
30%	24	44	66	107	7	-9	-15	-69	-60	-8	-11	14
40%	31	42	119	128	-21	-17	-30	-86	-60	-3	5	38
50%	79	83	260	126	-16	-23	-42	-49	-60	1	-4	33
60%	285	291	293	6	-38	-24	-16	-42	-56	0	-1	30
70%	282	297	280	11	-21	-21	-7	-36	-52	-6	-8	48
80%	284	262	209	-6	-14	-23	-6	-24	-49	-9	2	49
90%	254	222	43	-17	-33	1	1	22	-21	-8	-7	24
Long Term												
Full Simulation Period ^b	131	133	130	43	-21	-17	-19	-35	-50	-5	-8	27
Water Year Types ^c												
Wet (32%)	147	174	151	17	-28	-12	-6	-15	-34	-3	-6	5
Above Normal (16%)	107	92	105	72	-20	-27	-32	-52	-66	-7	1	126
Below Normal (13%)	156	150	165	108	6	-17	-21	-45	-75	0	14	16
Dry (24%)	143	136	157	59	-13	-16	-27	-51	-56	-6	-25	6
Critical (15%)	78	70	38	-16	-42	-16	-18	-24	-33	-12	-13	11

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.8.3. Banks Pumping Plant Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	771	833	888	834	671	615	556	514	481	432	566	651
20%	724	695	763	765	603	538	501	487	425	364	485	612
30%	684	649	685	649	557	493	451	462	393	335	424	577
40%	668	628	610	574	536	462	420	431	373	322	387	536
50%	605	561	439	537	506	421	394	376	361	311	371	523
60%	377	347	374	507	484	400	342	350	349	301	332	507
70%	360	323	334	454	435	369	312	330	338	292	314	478
80%	340	311	307	427	372	337	291	309	322	282	299	445
90%	317	296	295	403	348	299	245	198	283	268	286	422
Long Term												
Full Simulation Period ^b	534	521	532	575	508	442	398	386	374	333	394	525
Water Year Types ^c												
Wet (32%)	468	426	410	443	392	329	272	270	310	290	304	463
Above Normal (16%)	611	599	557	558	501	406	357	355	352	283	309	434
Below Normal (13%)	478	438	485	568	528	464	417	417	393	309	378	582
Dry (24%)	529	538	572	654	557	495	464	444	388	349	489	575
Critical (15%)	654	689	745	754	667	618	587	548	501	475	535	619
Alternative 5												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	768	837	890	837	671	615	591	559	537	457	575	650
20%	737	732	771	764	604	538	515	510	464	383	506	616
30%	691	652	688	649	557	493	465	467	438	342	446	592
40%	673	634	610	572	536	462	418	405	389	324	392	570
50%	625	572	440	535	507	421	396	370	363	314	372	526
60%	381	346	374	507	484	400	342	343	350	305	332	509
70%	361	320	335	454	435	371	313	328	339	292	314	488
80%	346	312	304	427	377	337	290	308	332	281	296	447
90%	319	297	296	404	348	301	246	200	284	270	280	418
Long Term												
Full Simulation Period ^b	538	524	532	576	509	444	404	394	394	338	400	531
Water Year Types ^c												
Wet (32%)	470	430	416	443	392	331	273	266	309	290	304	462
Above Normal (16%)	624	606	550	556	501	406	355	346	351	284	309	433
Below Normal (13%)	477	440	486	567	527	463	416	403	400	313	379	589
Dry (24%)	535	538	569	662	561	497	476	466	430	360	512	591
Critical (15%)	659	690	745	752	668	624	613	594	561	486	541	631
Alternative 5 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-3	4	2	3	0	0	36	45	57	25	9	-1
20%	12	37	8	-1	1	0	14	23	39	19	21	4
30%	7	3	3	0	0	0	14	5	46	7	21	15
40%	5	6	0	-2	1	0	-1	-26	16	2	5	35
50%	20	11	1	-3	1	0	2	-5	2	3	1	3
60%	4	-1	0	0	0	0	0	-7	0	5	0	2
70%	1	-3	1	0	0	2	1	-3	1	1	0	10
80%	5	1	-3	1	5	0	-1	-1	10	-1	-3	2
90%	1	1	1	1	0	2	1	1	1	3	-6	-4
Long Term												
Full Simulation Period ^b	5	3	0	1	1	1	6	8	20	5	6	6
Water Year Types ^c												
Wet (32%)	2	5	6	0	1	1	1	-3	-1	0	0	-1
Above Normal (16%)	13	7	-6	-2	0	0	-2	-9	-1	1	0	-1
Below Normal (13%)	-1	2	1	-1	-1	-1	-1	-15	7	3	1	6
Dry (24%)	6	0	-4	7	4	1	12	22	42	11	23	16
Critical (15%)	5	1	-1	-2	1	5	25	46	61	10	6	12

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.8.4. Banks Pumping Plant Salinity, Monthly EC

Second Basis of Comparison												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	758	827	853	856	674	545	459	419	426	413	523	635
20%	735	734	796	804	609	467	417	399	397	344	434	616
30%	727	701	762	730	528	429	374	379	340	326	409	585
40%	702	670	723	697	468	404	354	333	324	316	391	564
50%	688	655	695	668	449	386	336	320	313	307	358	549
60%	676	634	669	472	411	362	322	304	304	294	324	539
70%	652	609	613	419	375	336	306	299	297	284	310	528
80%	629	575	502	393	352	316	286	285	287	271	300	488
90%	571	474	334	351	315	297	229	213	277	261	287	464
Long Term												
Full Simulation Period ^b	668	646	658	603	475	400	352	336	335	324	378	548
Water Year Types^c												
Wet (32%)	620	594	548	421	349	319	264	254	292	289	300	479
Above Normal (16%)	708	667	649	593	442	368	319	304	300	274	312	554
Below Normal (13%)	634	594	649	654	561	443	379	347	305	293	381	553
Dry (24%)	684	664	722	700	519	414	377	371	354	333	436	583
Critical (15%)	731	755	809	802	635	546	512	477	460	465	521	631

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	771	833	888	834	671	615	556	514	481	432	566	651
20%	724	695	763	765	603	538	501	487	425	364	485	612
30%	684	649	685	649	557	493	451	462	393	335	424	577
40%	668	628	610	574	536	462	420	431	373	322	387	536
50%	605	561	439	537	506	421	394	376	361	311	371	523
60%	377	347	374	507	484	400	342	350	349	301	332	507
70%	360	323	334	454	435	369	312	330	338	292	314	478
80%	340	311	307	427	372	337	291	309	322	282	299	445
90%	317	296	295	403	348	299	245	198	283	268	286	422
Long Term												
Full Simulation Period ^b	534	521	532	575	508	442	398	386	374	333	394	525
Water Year Types^c												
Wet (32%)	468	426	410	443	392	329	272	270	310	290	304	463
Above Normal (16%)	611	599	557	558	501	406	357	355	352	283	309	434
Below Normal (13%)	478	438	485	568	528	464	417	417	393	309	378	582
Dry (24%)	529	538	572	654	557	495	464	444	388	349	489	575
Critical (15%)	654	689	745	754	667	618	587	548	501	475	535	619

No Action Alternative minus Second Basis of Comparison												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	14	5	35	-21	-3	70	97	95	55	19	43	15
20%	-10	-39	-33	-38	-6	71	84	87	29	20	51	-3
30%	-43	-52	-77	-81	29	63	77	83	52	9	16	-8
40%	-33	-41	-113	-123	68	58	66	98	49	6	-4	-28
50%	-83	-93	-256	-131	58	35	58	56	48	4	13	-26
60%	-299	-288	-295	36	73	38	20	45	45	6	8	-32
70%	-291	-286	-279	35	60	33	5	31	41	8	4	-50
80%	-289	-264	-194	33	20	21	4	24	35	12	-1	-43
90%	-254	-178	-39	52	32	2	16	-15	6	7	-1	-42
Long Term												
Full Simulation Period ^b	-134	-125	-126	-28	33	43	46	51	40	9	16	-24
Water Year Types^c												
Wet (32%)	-152	-168	-137	22	43	11	8	16	18	1	5	-15
Above Normal (16%)	-97	-69	-92	-35	59	38	38	51	52	9	-2	-120
Below Normal (13%)	-157	-156	-164	-86	-33	21	38	70	88	17	-3	29
Dry (24%)	-155	-126	-149	-46	38	81	87	72	34	16	53	-8
Critical (15%)	-78	-66	-64	-48	32	72	76	70	40	10	14	-11

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.8.5. Banks Pumping Plant Salinity, Monthly EC

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	758	827	853	856	674	545	459	419	426	413	523	635
20%	735	734	796	804	609	467	417	399	397	344	434	616
30%	727	701	762	730	528	429	374	379	340	326	409	585
40%	702	670	723	697	468	404	354	333	324	316	391	564
50%	688	655	695	668	449	386	336	320	313	307	358	549
60%	676	634	669	472	411	362	322	304	304	294	324	539
70%	652	609	613	419	375	336	306	299	297	284	310	528
80%	629	575	502	393	352	316	286	285	287	271	300	488
90%	571	474	334	351	315	297	229	213	277	261	287	464
Long Term												
Full Simulation Period ^b	668	646	658	603	475	400	352	336	335	324	378	548
Water Year Types ^c												
Wet (32%)	620	594	548	421	349	319	264	254	292	289	300	479
Above Normal (16%)	708	667	649	593	442	368	319	304	300	274	312	554
Below Normal (13%)	634	594	649	654	561	443	379	347	305	293	381	553
Dry (24%)	684	664	722	700	519	414	377	371	354	333	436	583
Critical (15%)	731	755	809	802	635	546	512	477	460	465	521	631

Alternative 3

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	780	827	864	849	655	582	538	497	398	424	573	666
20%	734	739	790	799	597	525	493	450	360	351	455	628
30%	708	693	751	756	563	484	436	393	333	327	413	591
40%	699	670	729	701	515	445	390	345	313	319	392	573
50%	684	644	699	664	491	398	352	327	301	313	367	556
60%	662	638	667	514	447	376	326	308	294	301	331	537
70%	642	620	614	465	414	348	305	294	286	286	307	527
80%	624	573	516	420	358	314	285	285	273	274	301	494
90%	571	518	338	386	314	300	247	220	261	260	279	446
Long Term												
Full Simulation Period ^b	665	654	662	618	487	426	379	351	325	328	386	551
Water Year Types ^c												
Wet (32%)	615	600	561	459	364	318	267	255	275	287	298	468
Above Normal (16%)	718	690	662	631	482	379	325	303	286	275	310	560
Below Normal (13%)	634	588	650	676	534	447	396	372	318	310	392	598
Dry (24%)	671	674	729	713	543	479	437	393	332	344	465	581
Critical (15%)	732	759	783	738	625	603	570	524	468	463	522	630

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	22	0	11	-6	-19	37	79	78	-27	11	50	31
20%	0	4	-6	-4	-12	58	76	51	-37	7	22	12
30%	-19	-8	-11	26	36	55	62	13	-8	1	5	6
40%	-2	0	6	4	47	41	36	12	-11	3	1	10
50%	-4	-10	4	-5	42	12	16	7	-12	5	9	7
60%	-14	3	-3	42	35	14	4	3	-10	7	7	-2
70%	-10	11	1	46	38	12	-2	-5	-11	2	-4	-2
80%	-5	-1	14	27	6	-2	-1	0	-14	3	1	6
90%	0	44	4	35	-1	3	17	7	-15	-1	-8	-18
Long Term												
Full Simulation Period ^b	-3	8	4	15	12	26	27	16	-10	4	8	3
Water Year Types ^c												
Wet (32%)	-5	6	13	39	15	-1	2	1	-16	-1	-2	-11
Above Normal (16%)	10	23	13	38	40	11	6	-1	-14	1	-1	5
Below Normal (13%)	0	-6	1	21	-27	4	17	25	13	17	11	45
Dry (24%)	-13	10	8	13	25	65	61	22	-22	10	29	-2
Critical (15%)	0	5	-26	-64	-10	57	58	47	8	-1	2	0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.8.6. Banks Pumping Plant Salinity, Monthly EC

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	758	827	853	856	674	545	459	419	426	413	523	635
20%	735	734	796	804	609	467	417	399	397	344	434	616
30%	727	701	762	730	528	429	374	379	340	326	409	585
40%	702	670	723	697	468	404	354	333	324	316	391	564
50%	688	655	695	668	449	386	336	320	313	307	358	549
60%	676	634	669	472	411	362	322	304	304	294	324	539
70%	652	609	613	419	375	336	306	299	297	284	310	528
80%	629	575	502	393	352	316	286	285	287	271	300	488
90%	571	474	334	351	315	297	229	213	277	261	287	464
Long Term												
Full Simulation Period ^b	668	646	658	603	475	400	352	336	335	324	378	548
Water Year Types ^c												
Wet (32%)	620	594	548	421	349	319	264	254	292	289	300	479
Above Normal (16%)	708	667	649	593	442	368	319	304	300	274	312	554
Below Normal (13%)	634	594	649	654	561	443	379	347	305	293	381	553
Dry (24%)	684	664	722	700	519	414	377	371	354	333	436	583
Critical (15%)	731	755	809	802	635	546	512	477	460	465	521	631

Alternative 5

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	768	837	890	837	671	615	591	559	537	457	575	650
20%	737	732	771	764	604	538	515	510	464	383	506	616
30%	691	652	688	649	557	493	465	467	438	342	446	592
40%	673	634	610	572	536	462	418	405	389	324	392	570
50%	625	572	440	535	507	421	396	370	363	314	372	526
60%	381	346	374	507	484	400	342	343	350	305	332	509
70%	361	320	335	454	435	371	313	328	339	292	314	488
80%	346	312	304	427	377	337	290	308	332	281	296	447
90%	319	297	296	404	348	301	246	200	284	270	280	418
Long Term												
Full Simulation Period ^b	538	524	532	576	509	444	404	394	394	338	400	531
Water Year Types ^c												
Wet (32%)	470	430	416	443	392	331	273	266	309	290	304	462
Above Normal (16%)	624	606	550	556	501	406	355	346	351	284	309	433
Below Normal (13%)	477	440	486	567	527	463	416	403	400	313	379	589
Dry (24%)	535	538	569	662	561	497	476	466	430	360	512	591
Critical (15%)	659	690	745	752	668	624	613	594	561	486	541	631

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	10	10	37	-19	-3	70	133	140	112	44	52	15
20%	2	-2	-25	-39	-5	71	98	111	67	38	72	1
30%	-36	-49	-74	-81	29	64	92	88	98	16	37	7
40%	-29	-36	-113	-125	68	58	64	72	65	8	2	7
50%	-63	-82	-255	-134	58	35	60	50	50	7	14	-23
60%	-295	-289	-295	36	73	38	20	38	46	11	8	-30
70%	-291	-289	-278	35	60	35	6	28	43	8	4	-40
80%	-283	-262	-197	34	25	21	4	23	45	10	-4	-41
90%	-252	-178	-38	53	32	4	17	-13	7	10	-7	-46
Long Term												
Full Simulation Period ^b	-129	-122	-126	-27	34	44	52	58	60	14	22	-18
Water Year Types ^c												
Wet (32%)	-150	-164	-132	22	44	12	9	12	17	1	4	-16
Above Normal (16%)	-85	-61	-99	-36	59	38	36	42	51	10	-3	-121
Below Normal (13%)	-158	-154	-164	-87	-34	20	37	56	95	20	-2	35
Dry (24%)	-149	-126	-153	-38	42	82	99	94	76	27	76	8
Critical (15%)	-73	-64	-64	-50	33	78	101	117	101	21	20	0

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 **B.9. Antioch Salinity**

Figure 6E.B.9.1. Antioch Salinity, Electrical Conductivity, October

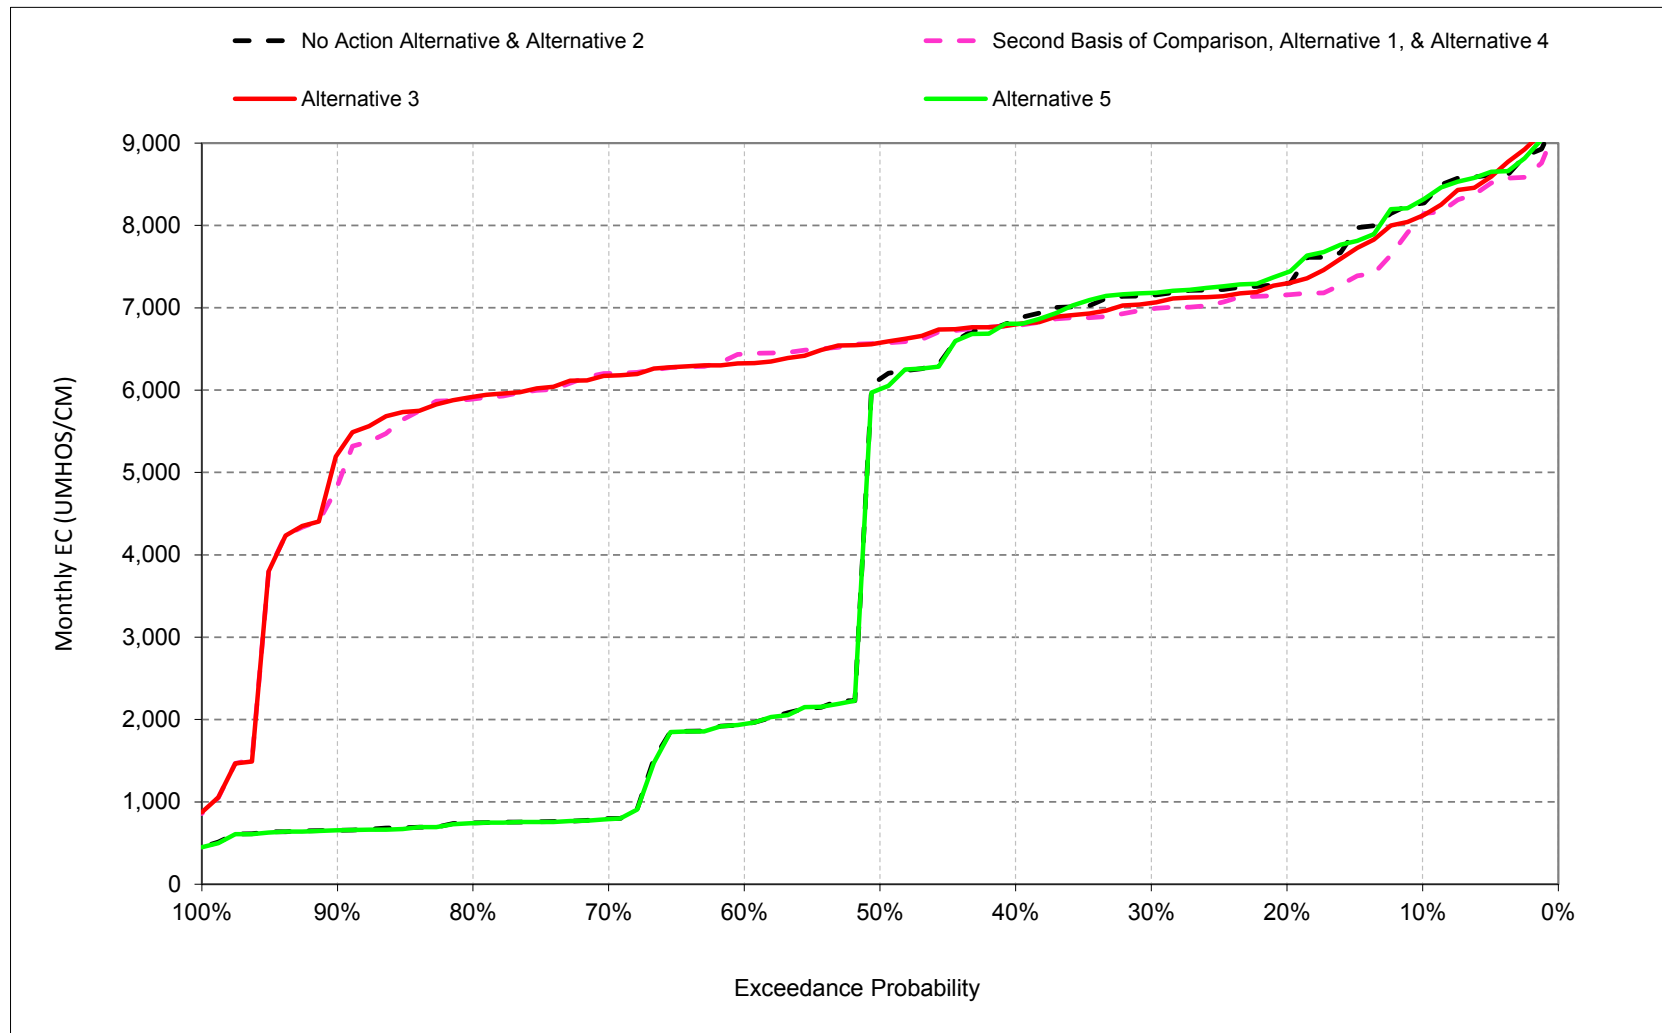


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.9.2. Antioch Salinity, Electrical Conductivity, November

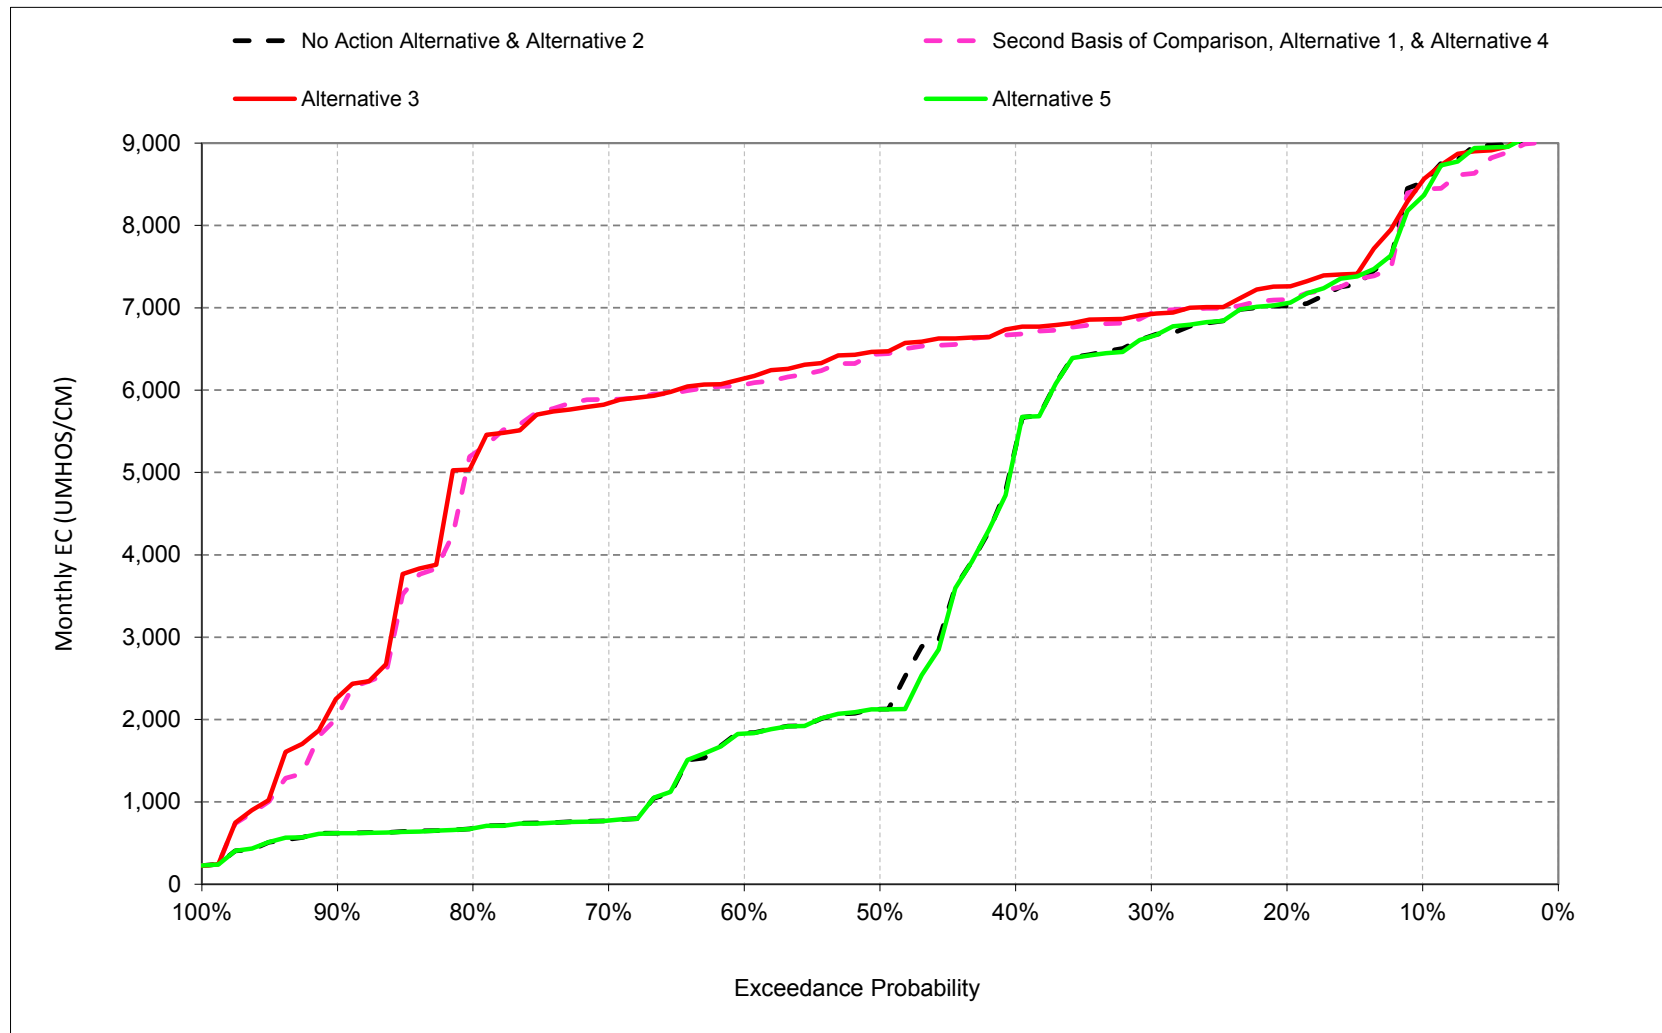


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.9.3. Antioch Salinity, Electrical Conductivity, December

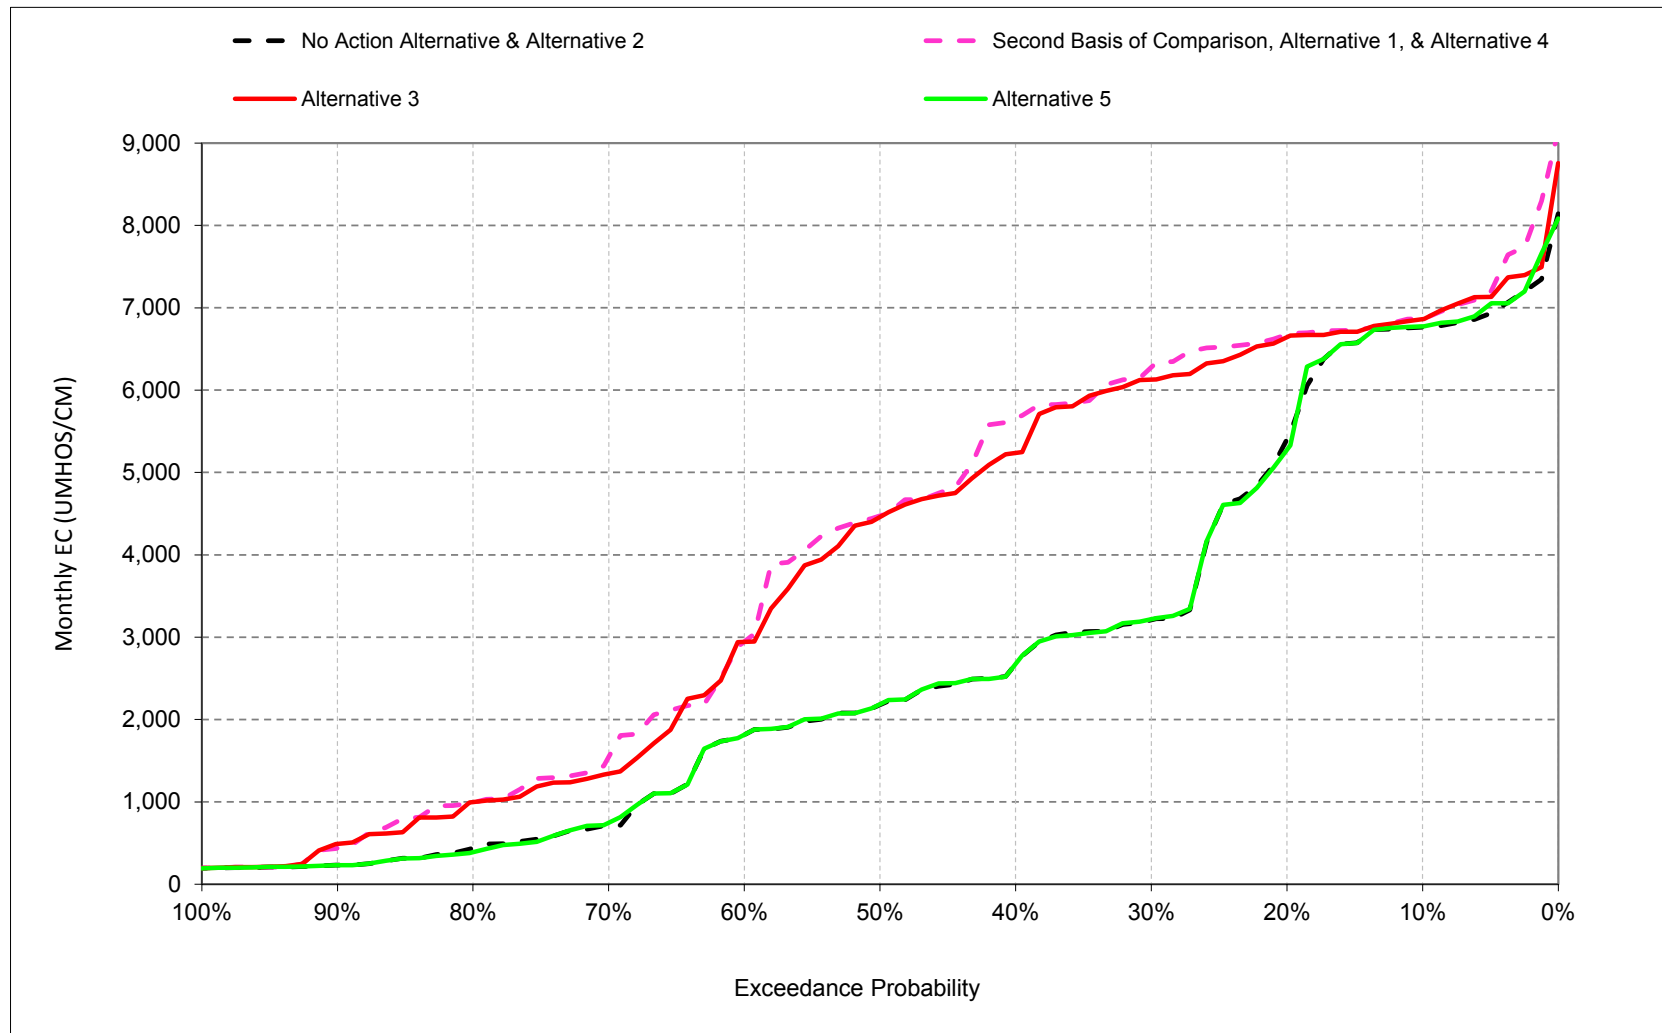


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.9.4. Antioch Salinity, Electrical Conductivity, January

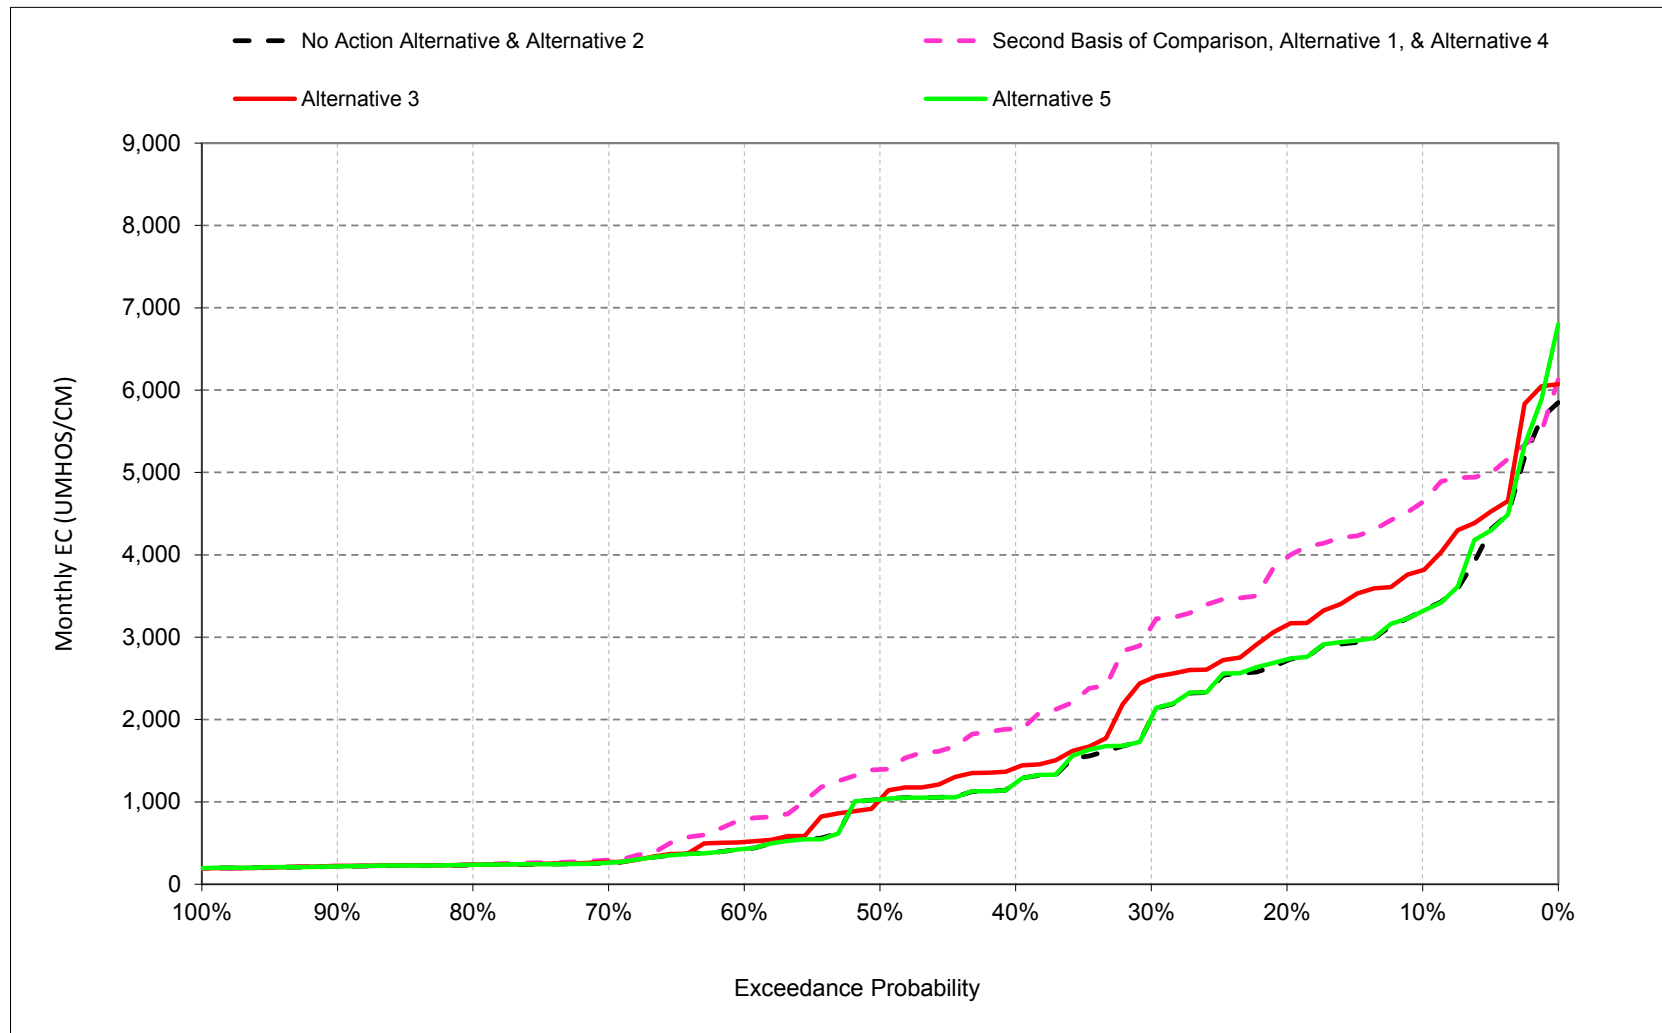


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.9.5. Antioch Salinity, Electrical Conductivity, February

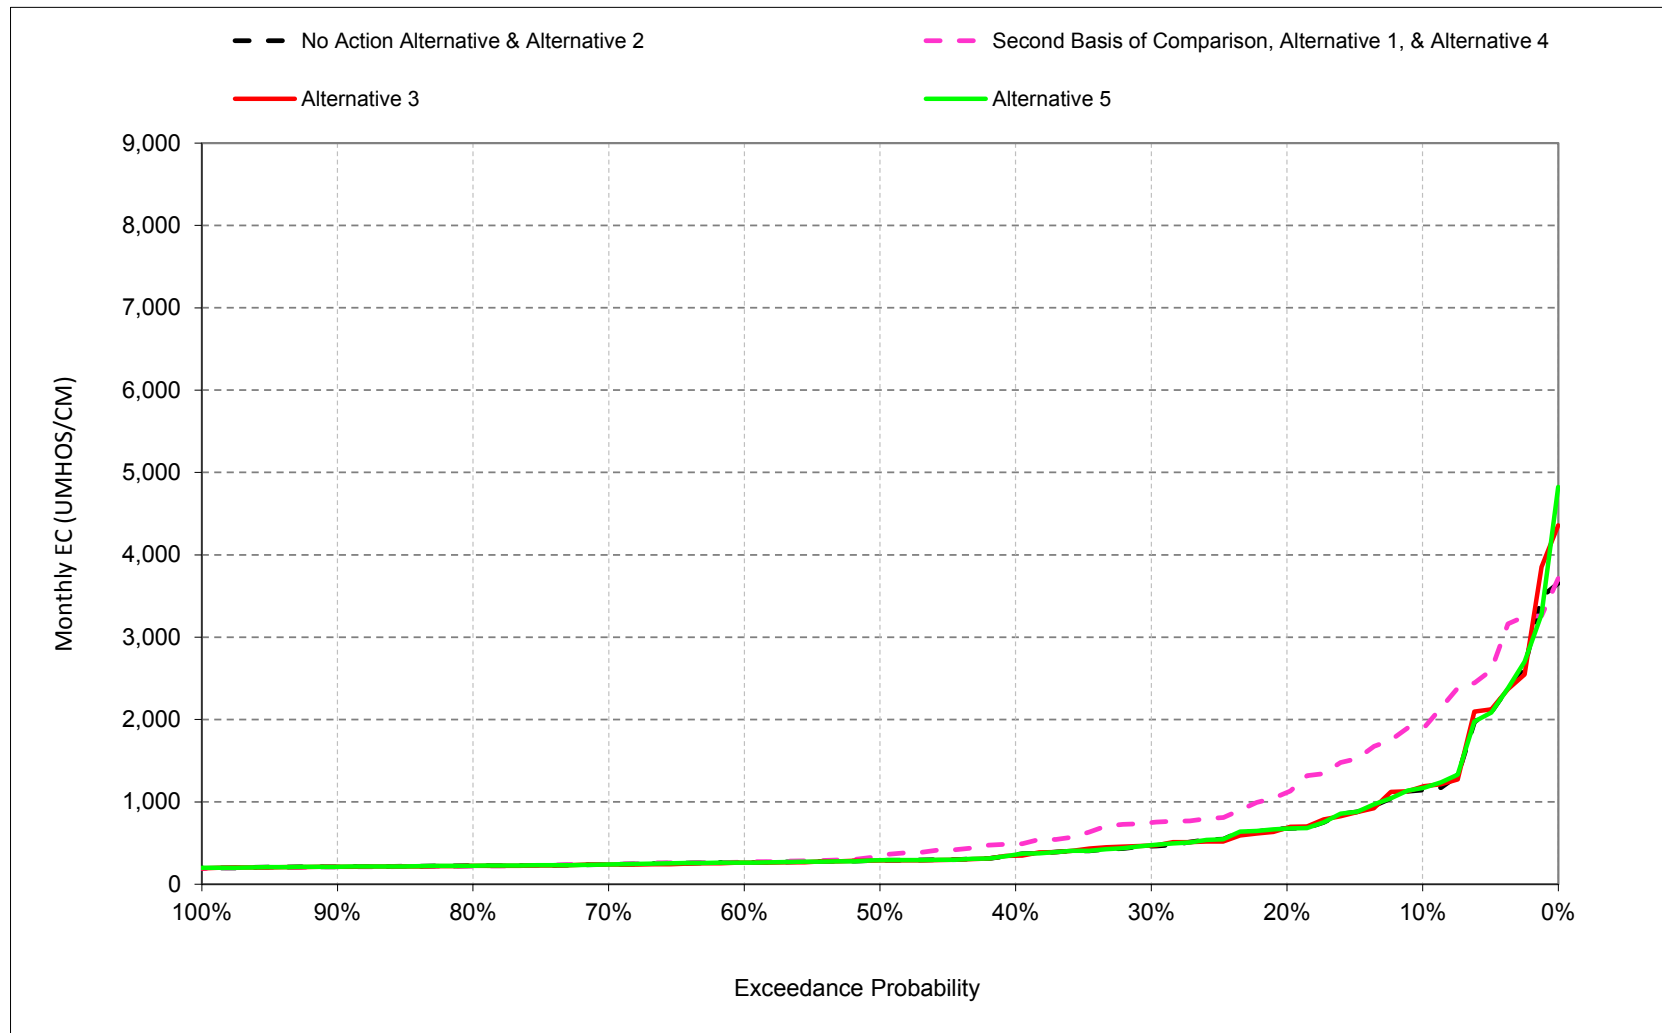


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.9.6. Antioch Salinity, Electrical Conductivity, March

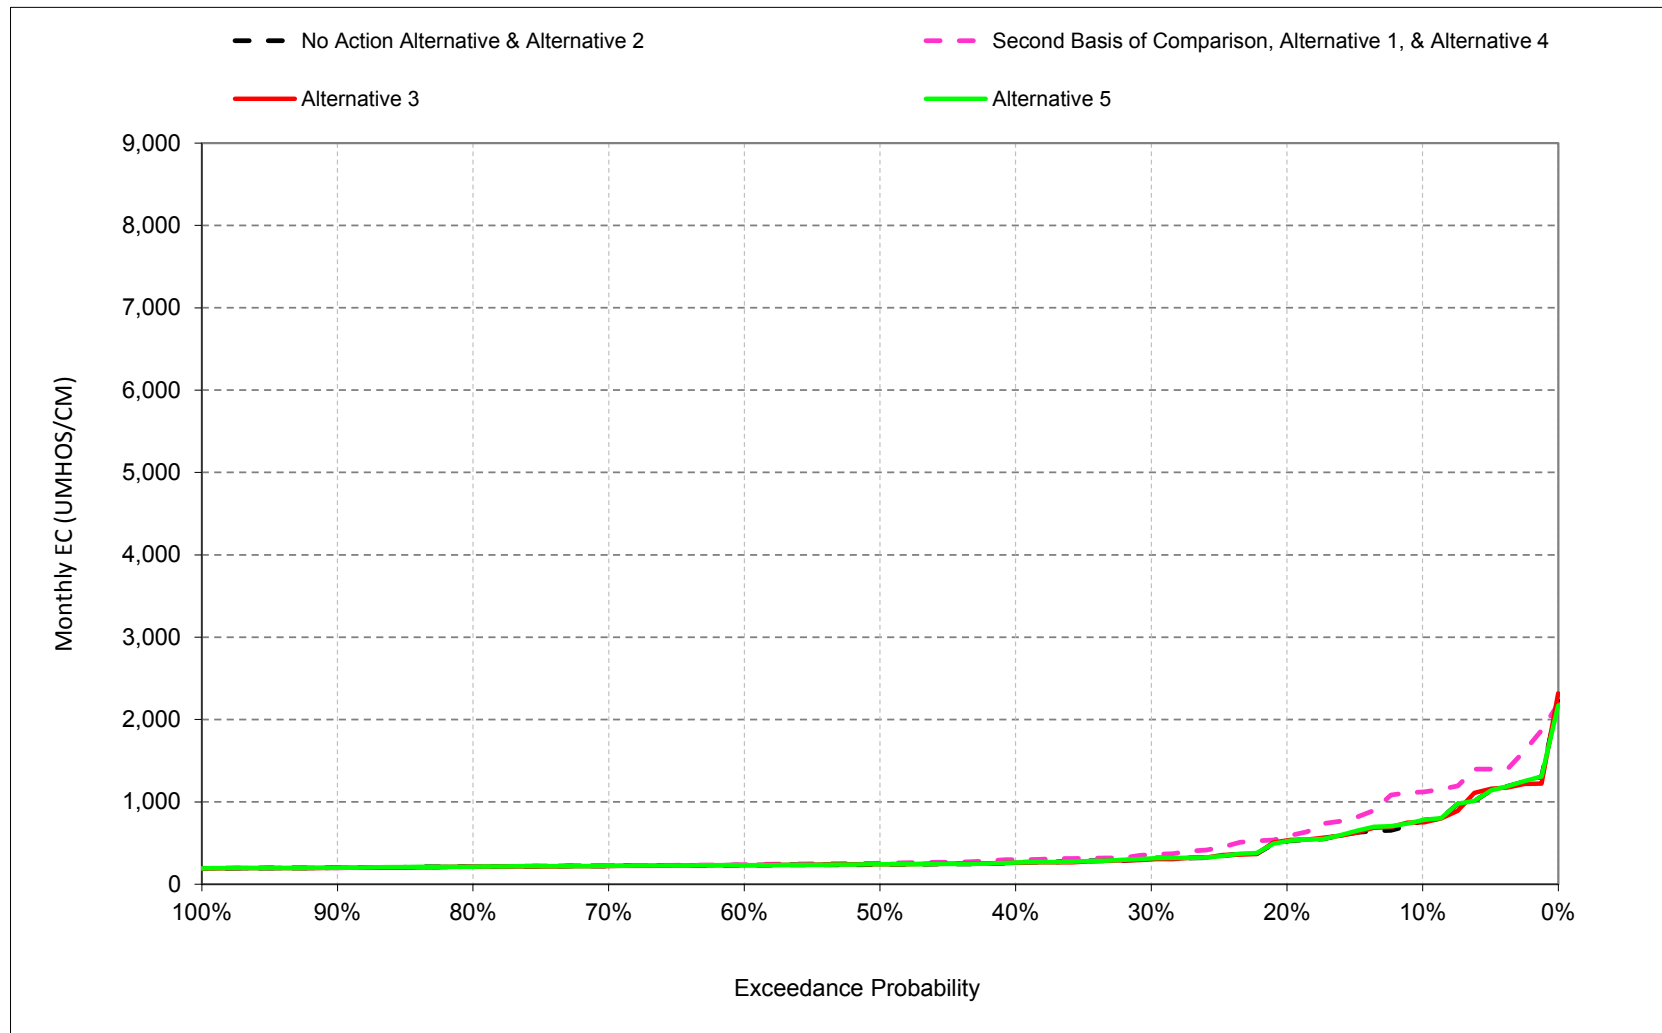


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.9.7. Antioch Salinity, Electrical Conductivity, April

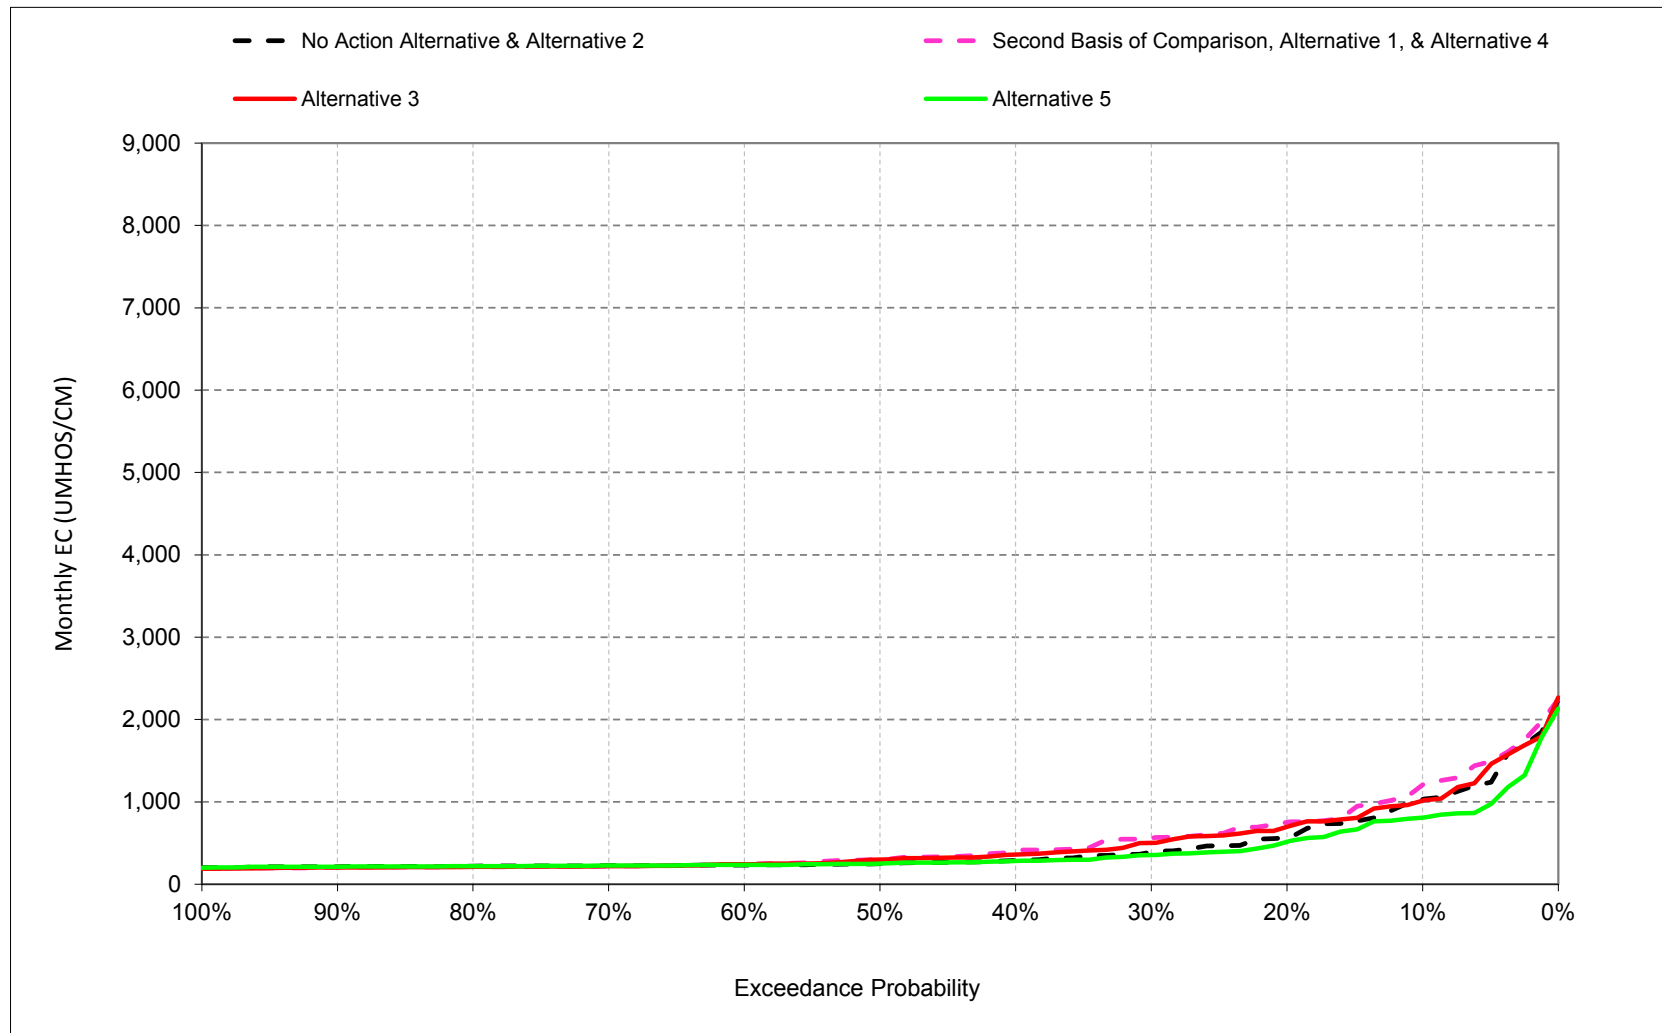


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.9.8. Antioch Salinity, Electrical Conductivity, May

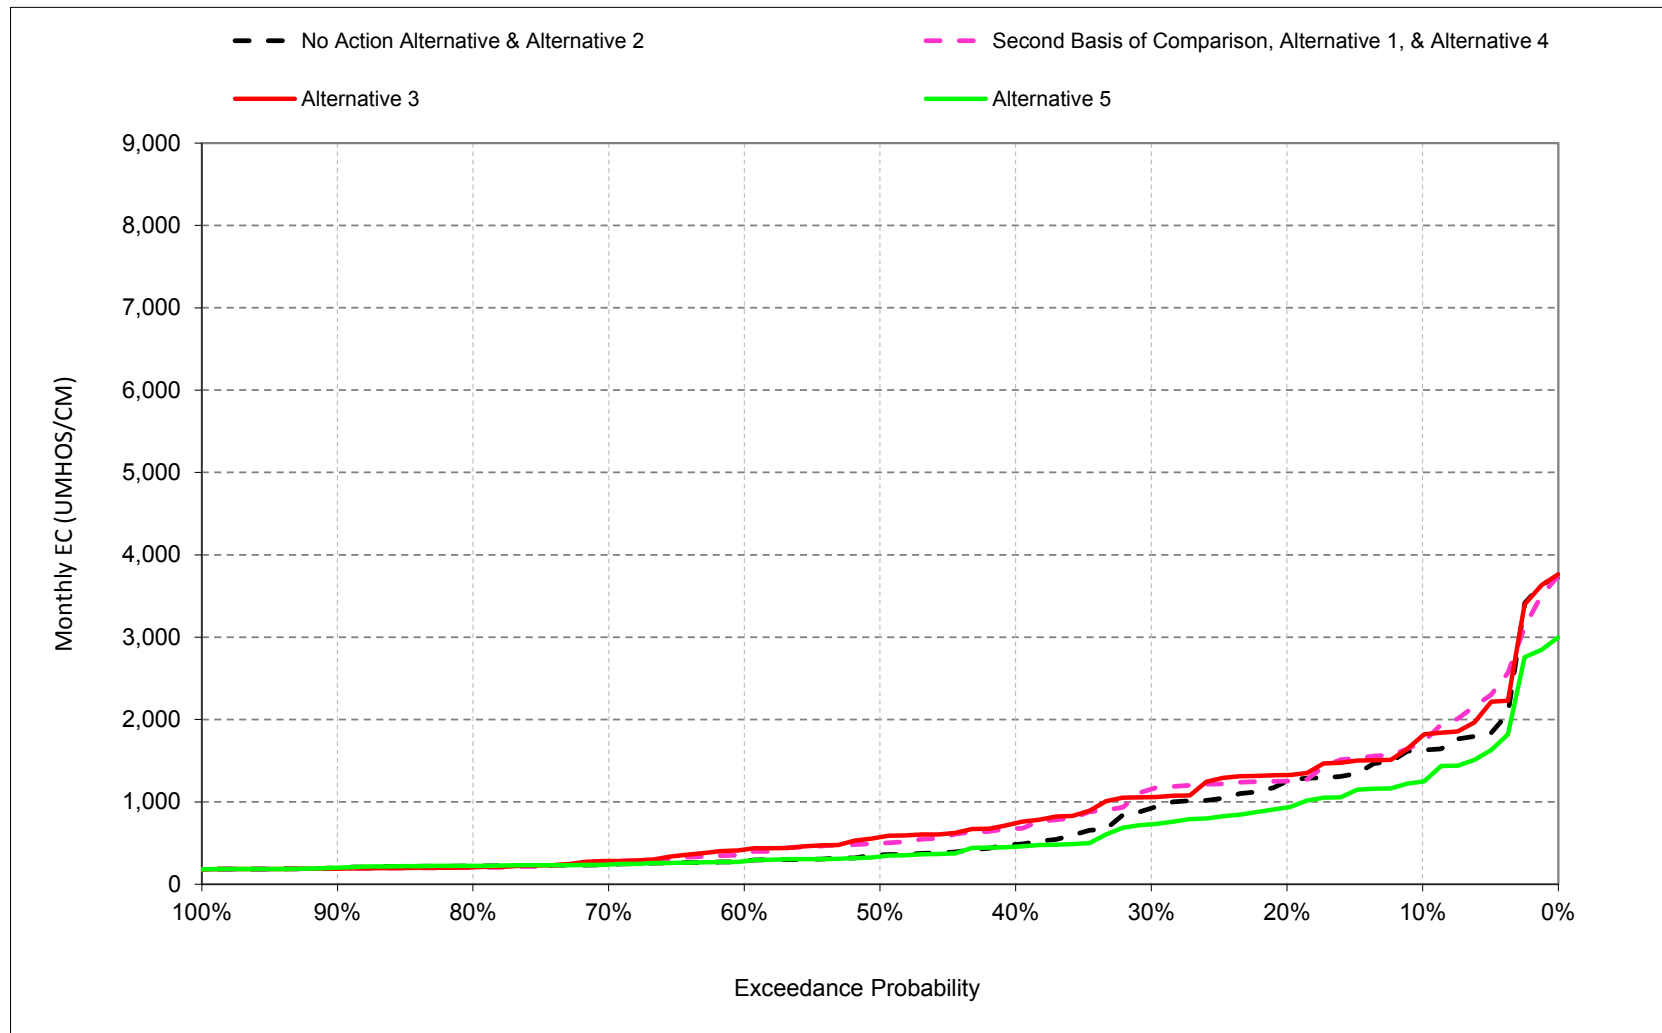


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.9.9. Antioch Salinity, Electrical Conductivity, June

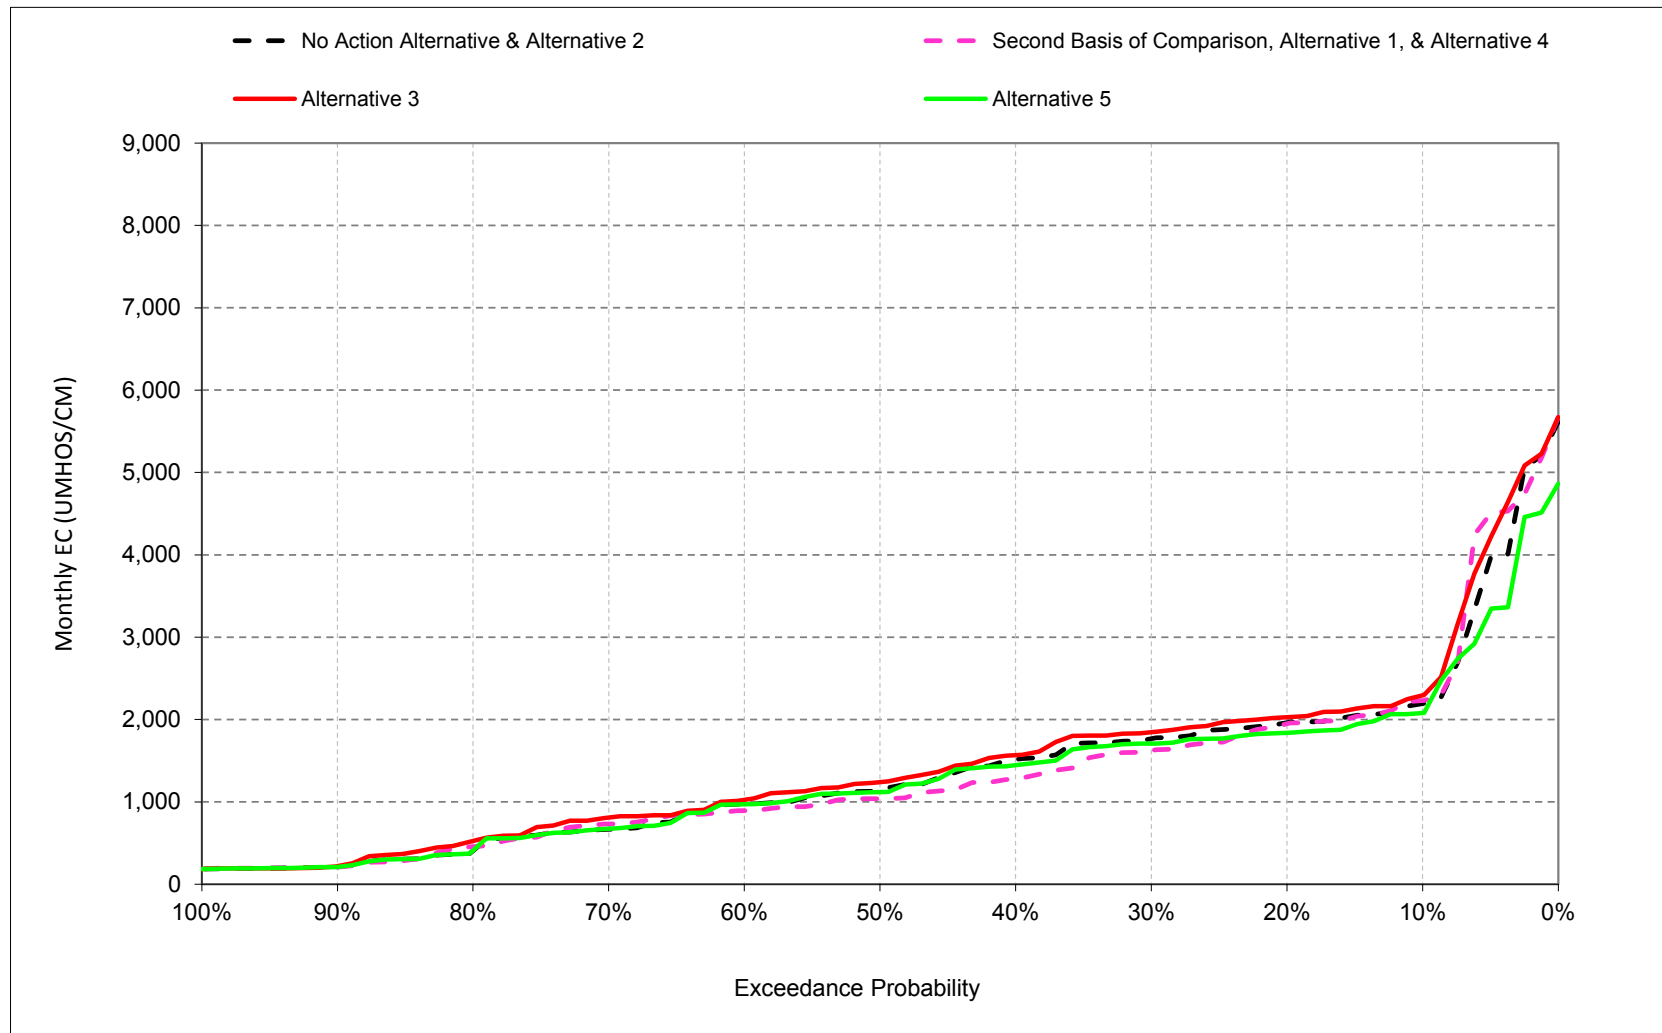


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.9.10. Antioch Salinity, Electrical Conductivity, July

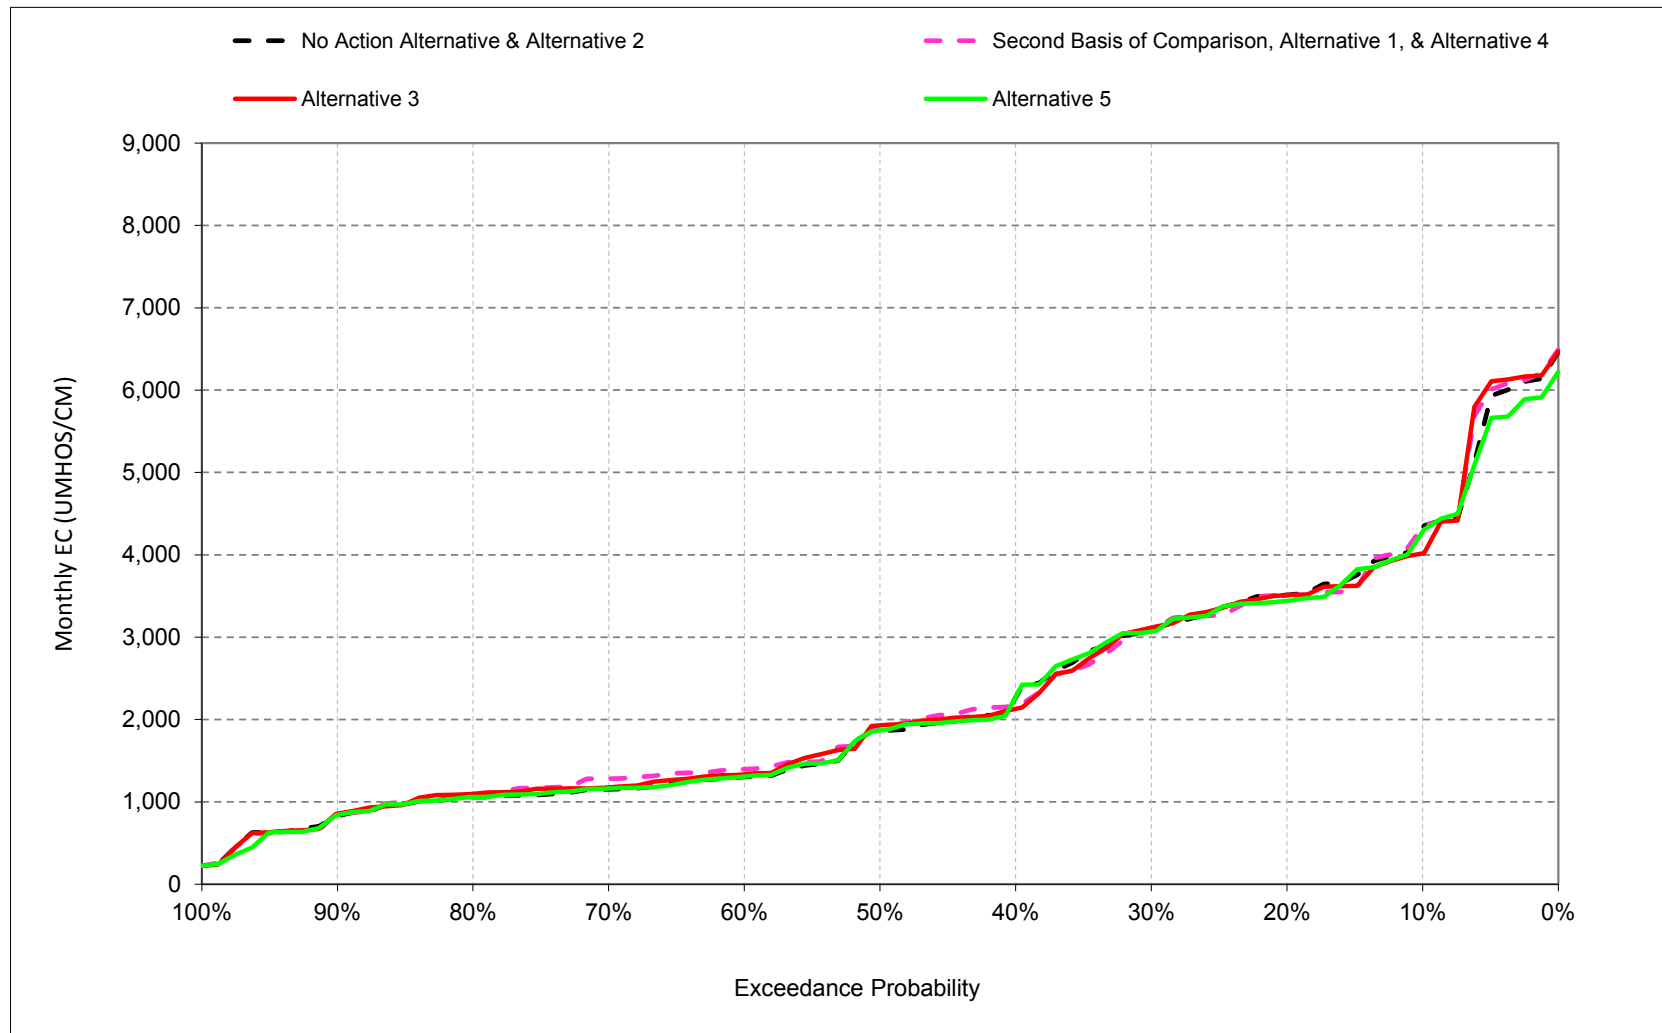


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.9.11. Antioch Salinity, Electrical Conductivity, August

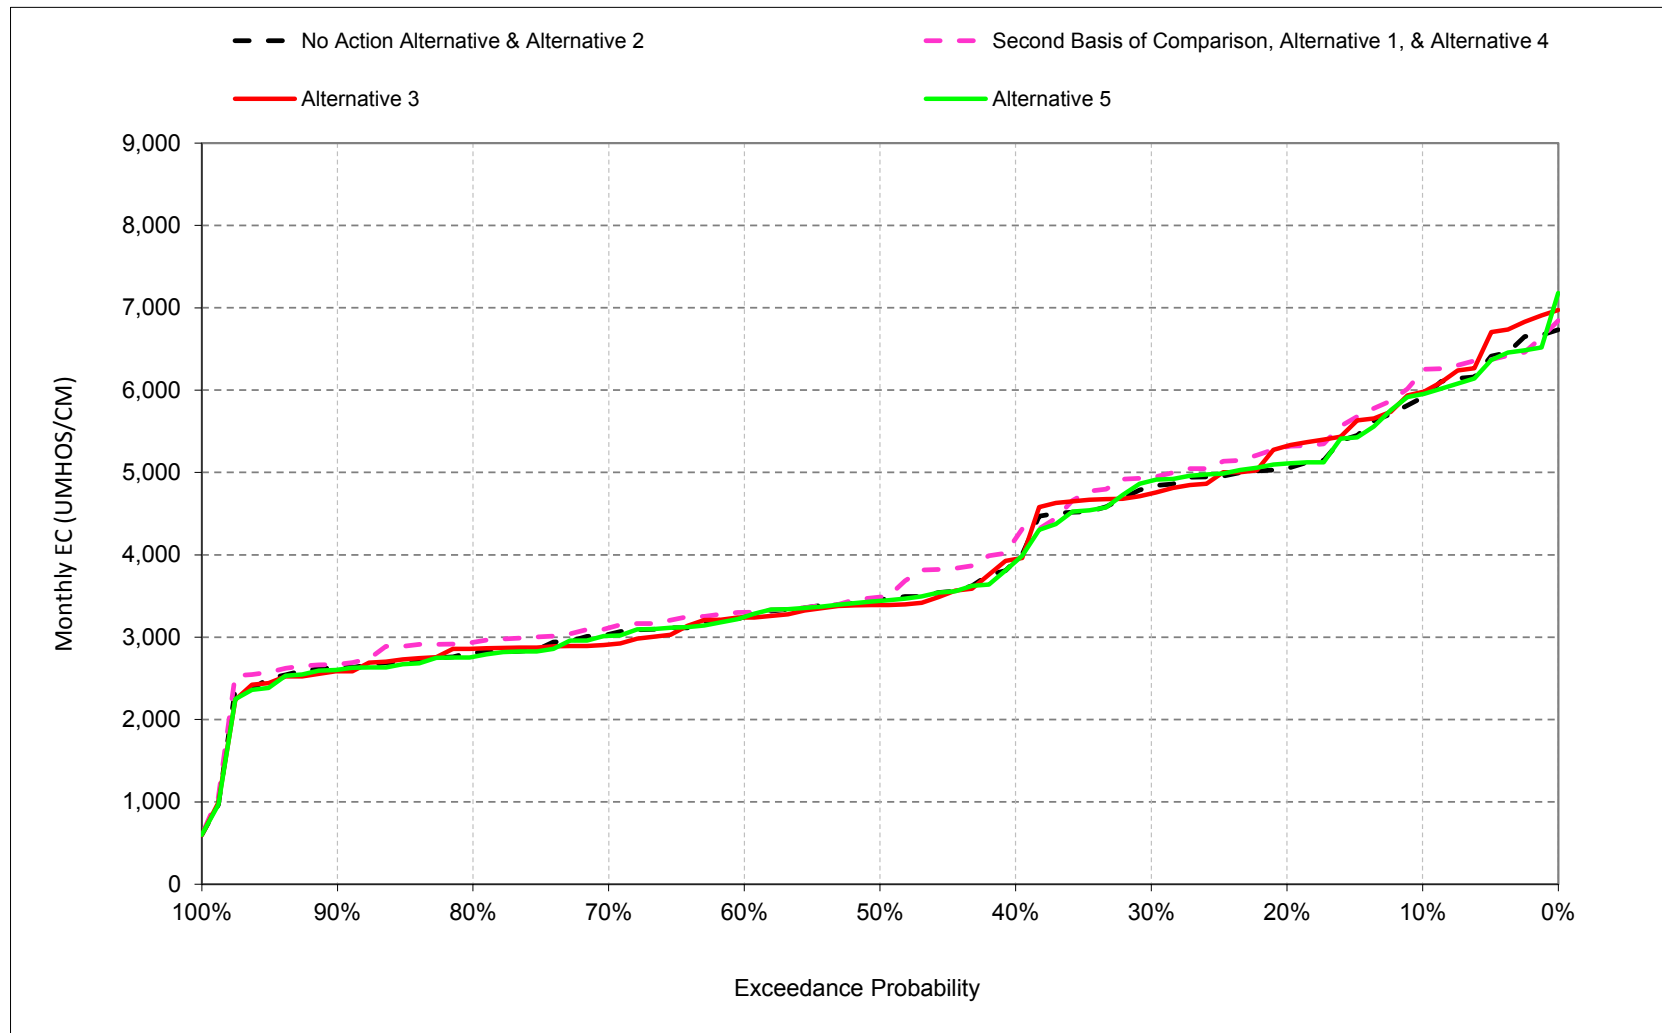

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.9.12. Antioch Salinity, Electrical Conductivity, September

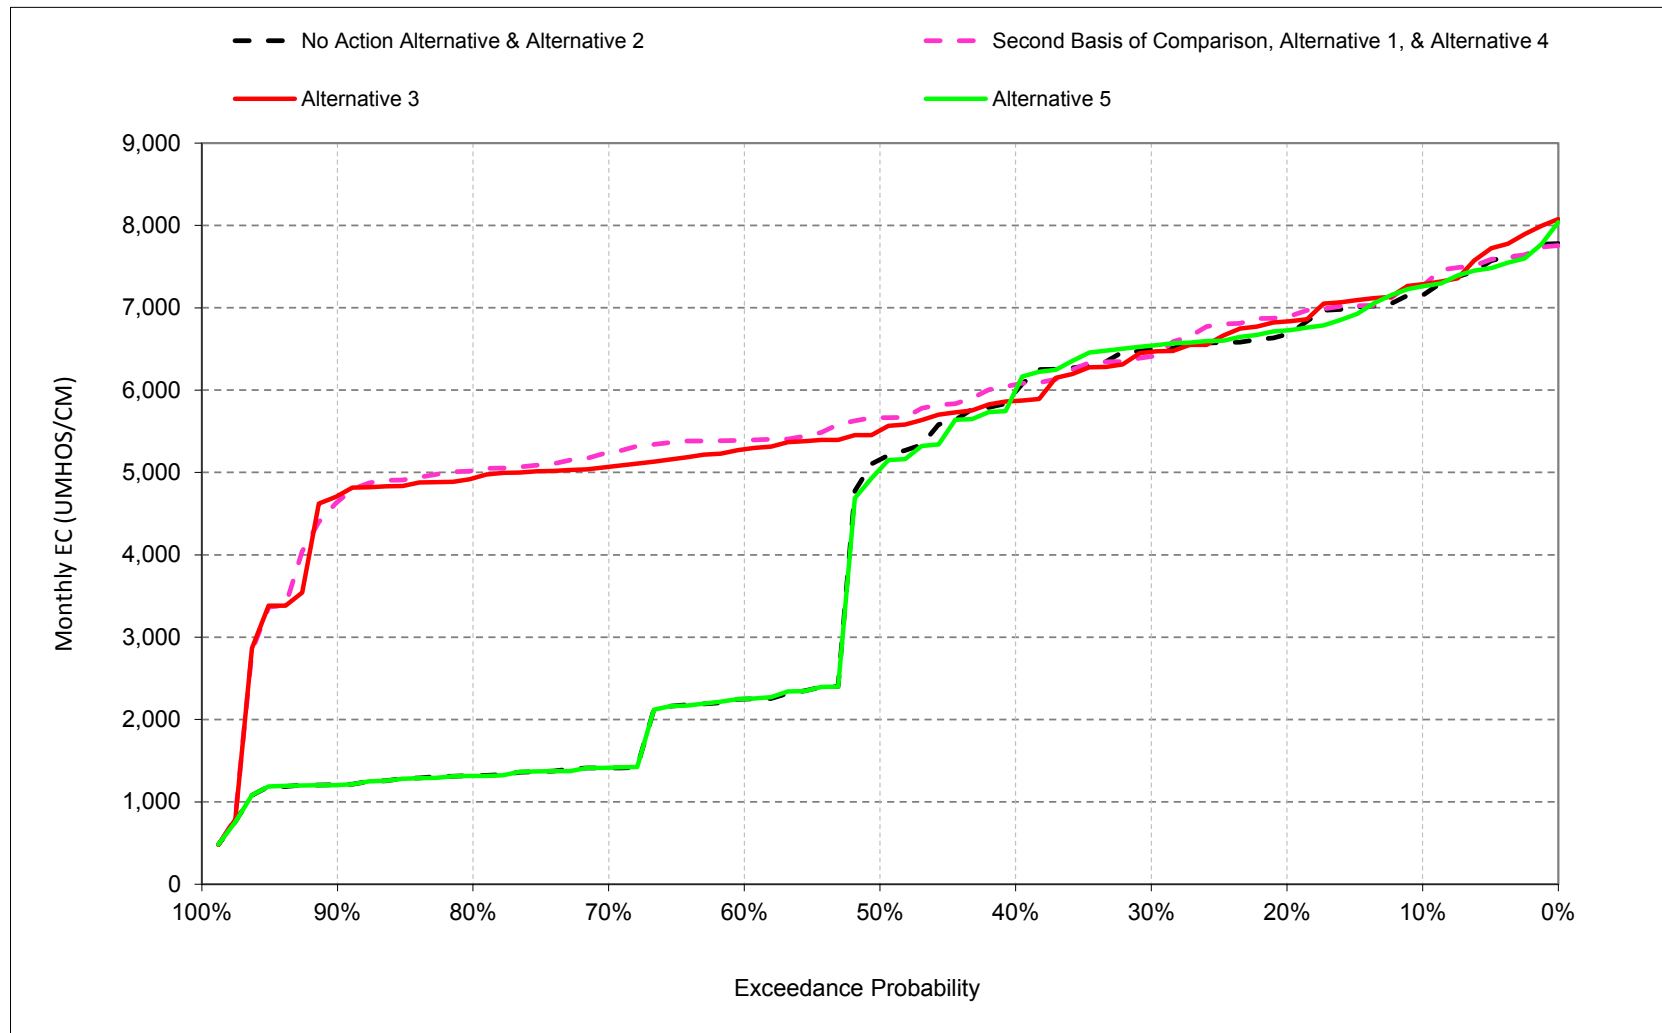

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.9.1. Antioch Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	8,269	8,523	6,763	3,320	1,142	771	1,029	1,628	2,192	4,322	5,909	7,163
20%	7,297	7,021	5,403	2,716	676	521	564	1,250	1,960	3,511	5,054	6,677
30%	7,151	6,658	3,210	2,015	462	313	392	922	1,767	3,094	4,825	6,497
40%	6,852	5,310	2,674	1,230	357	262	288	485	1,514	2,268	3,930	5,981
50%	6,136	2,127	2,179	1,030	289	241	250	356	1,150	1,863	3,459	5,157
60%	1,944	1,839	1,814	430	264	232	232	281	974	1,303	3,247	2,247
70%	797	774	712	261	238	223	225	238	667	1,153	3,035	1,414
80%	745	678	437	234	224	214	219	221	406	1,057	2,812	1,322
90%	655	621	231	215	212	200	213	200	209	829	2,632	1,219
Long Term												
Full Simulation Period ^b	4,357	3,817	2,769	1,427	569	384	449	722	1,384	2,278	3,917	4,173
Water Year Types ^c												
Wet (32%)	2,942	2,175	861	374	241	221	223	241	545	919	2,804	1,244
Above Normal (16%)	5,638	4,065	2,362	727	275	225	233	298	963	1,247	2,878	2,243
Below Normal (13%)	3,018	2,846	2,728	1,564	576	397	430	669	1,448	1,961	3,512	5,704
Dry (24%)	4,693	4,494	3,908	2,128	741	403	471	830	1,609	3,290	4,892	6,457
Critical (15%)	6,705	6,865	5,485	3,174	1,303	867	1,153	2,093	3,225	4,943	6,200	7,400
Alternative 1												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	8,123	8,439	6,868	4,639	1,903	1,120	1,205	1,726	2,229	4,336	6,230	7,278
20%	7,156	7,100	6,677	3,967	1,113	581	751	1,252	1,947	3,509	5,312	6,895
30%	6,985	6,934	6,276	3,125	748	361	563	1,154	1,625	3,100	4,945	6,407
40%	6,786	6,677	5,659	1,885	489	298	402	676	1,283	2,177	4,198	6,066
50%	6,571	6,439	4,473	1,391	345	255	302	497	1,039	1,890	3,486	5,666
60%	6,439	6,067	2,944	784	269	238	242	371	893	1,398	3,302	5,393
70%	6,203	5,888	1,546	292	242	227	220	278	730	1,281	3,112	5,241
80%	5,892	5,219	989	238	219	214	210	203	456	1,058	2,936	5,022
90%	4,839	2,042	438	215	210	199	205	190	208	853	2,670	4,657
Long Term												
Full Simulation Period ^b	6,379	5,877	4,016	1,934	755	454	513	821	1,354	2,307	4,038	5,739
Water Year Types ^c												
Wet (32%)	5,652	4,968	1,663	482	248	222	231	277	510	969	2,846	4,539
Above Normal (16%)	6,900	5,688	3,849	1,169	338	228	255	394	864	1,288	3,015	5,204
Below Normal (13%)	5,956	5,206	4,384	2,752	1,026	505	550	839	1,245	2,015	3,765	5,818
Dry (24%)	6,661	6,582	5,503	2,942	1,004	481	560	933	1,607	3,240	5,044	6,588
Critical (15%)	7,307	7,494	6,481	3,480	1,639	1,112	1,291	2,258	3,390	5,021	6,298	7,433
Alternative 1 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-147	-84	104	1,318	760	349	177	98	36	13	321	115
20%	-141	79	1,274	1,251	437	60	187	2	-13	-2	258	218
30%	-166	276	3,067	1,110	287	47	171	231	-143	5	119	-90
40%	-66	1,367	2,985	655	132	36	114	191	-231	-91	268	85
50%	435	4,312	2,294	362	56	14	52	141	-111	27	27	509
60%	4,495	4,228	1,131	354	5	6	10	90	-82	94	55	3,146
70%	5,406	5,115	835	31	4	4	-5	39	64	128	78	3,827
80%	5,147	4,540	552	4	-5	-1	-9	-18	50	1	124	3,700
90%	4,184	1,422	206	0	-2	-1	-8	-10	-1	24	38	3,438
Long Term												
Full Simulation Period ^b	2,022	2,061	1,247	507	186	70	64	99	-30	29	121	1,566
Water Year Types ^c												
Wet (32%)	2,709	2,793	802	108	7	1	9	36	-36	50	42	3,295
Above Normal (16%)	1,262	1,622	1,488	442	64	4	22	96	-99	42	138	2,961
Below Normal (13%)	2,938	2,360	1,656	1,188	449	107	120	170	-203	54	253	114
Dry (24%)	1,968	2,088	1,595	813	262	79	89	103	-2	-50	153	132
Critical (15%)	603	629	996	306	336	245	138	164	166	78	98	32

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.9.2. Antioch Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	8,269	8,523	6,763	3,320	1,142	771	1,029	1,628	2,192	4,322	5,909	7,163
20%	7,297	7,021	5,403	2,716	676	521	564	1,250	1,960	3,511	5,054	6,677
30%	7,151	6,658	3,210	2,015	462	313	392	922	1,767	3,094	4,825	6,497
40%	6,852	5,310	2,674	1,230	357	262	288	485	1,514	2,268	3,930	5,981
50%	6,136	2,127	2,179	1,030	289	241	250	356	1,150	1,863	3,459	5,157
60%	1,944	1,839	1,814	430	264	232	232	281	974	1,303	3,247	2,247
70%	797	774	712	261	238	223	225	238	667	1,153	3,035	1,414
80%	745	678	437	234	224	214	219	221	406	1,057	2,812	1,322
90%	655	621	231	215	212	200	213	200	209	829	2,632	1,219
Long Term												
Full Simulation Period ^b	4,357	3,817	2,769	1,427	569	384	449	722	1,384	2,278	3,917	4,173
Water Year Types ^c												
Wet (32%)	2,942	2,175	861	374	241	221	223	241	545	919	2,804	1,244
Above Normal (16%)	5,638	4,065	2,362	727	275	225	233	298	963	1,247	2,878	2,243
Below Normal (13%)	3,018	2,846	2,728	1,564	576	397	430	669	1,448	1,961	3,512	5,704
Dry (24%)	4,693	4,494	3,908	2,128	741	403	471	830	1,609	3,290	4,892	6,457
Critical (15%)	6,705	6,865	5,485	3,174	1,303	867	1,153	2,093	3,225	4,943	6,200	7,400
Alternative 3												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	8,118	8,539	6,862	3,812	1,184	752	1,013	1,802	2,292	4,016	5,977	7,286
20%	7,295	7,260	6,644	3,146	683	530	695	1,327	2,027	3,511	5,322	6,834
30%	7,057	6,924	6,126	2,499	470	300	502	1,056	1,846	3,116	4,744	6,466
40%	6,798	6,757	5,238	1,413	345	259	361	742	1,566	2,128	3,948	5,868
50%	6,576	6,468	4,459	1,027	287	242	298	571	1,240	1,929	3,389	5,510
60%	6,325	6,142	2,942	511	261	231	242	421	1,025	1,334	3,240	5,284
70%	6,176	5,841	1,343	269	239	220	217	281	808	1,175	2,910	5,068
80%	5,918	5,120	997	237	222	212	210	205	525	1,098	2,860	4,930
90%	5,223	2,265	488	223	210	199	203	189	218	856	2,585	4,796
Long Term												
Full Simulation Period ^b	6,445	5,963	3,907	1,606	582	384	482	831	1,476	2,294	3,940	5,678
Water Year Types ^c												
Wet (32%)	5,617	5,033	1,607	415	238	221	229	299	610	950	2,741	4,498
Above Normal (16%)	7,143	5,772	3,619	868	270	220	248	412	1,002	1,270	2,928	5,152
Below Normal (13%)	6,062	5,318	4,395	1,974	614	404	512	863	1,593	1,980	3,488	5,527
Dry (24%)	6,669	6,676	5,442	2,367	731	400	514	954	1,716	3,234	4,967	6,559
Critical (15%)	7,462	7,590	6,198	3,380	1,391	871	1,202	2,205	3,354	5,038	6,338	7,470
Alternative 3 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-152	16	98	492	42	-19	-16	175	100	-306	68	123
20%	-2	239	1,240	430	7	9	131	77	67	0	269	157
30%	-93	266	2,917	484	8	-13	110	134	78	21	-82	-31
40%	-54	1,447	2,564	183	-12	-3	73	257	52	-140	18	-113
50%	440	4,341	2,279	-2	-3	0	48	215	90	66	-70	353
60%	4,381	4,303	1,128	81	-2	-1	10	140	50	31	-7	3,036
70%	5,379	5,068	631	8	1	-2	-7	42	141	22	-125	3,654
80%	5,173	4,441	560	3	-2	-2	-9	-16	118	41	48	3,607
90%	4,568	1,645	257	8	-2	-1	-10	-11	8	27	-47	3,576
Long Term												
Full Simulation Period ^b	2,088	2,147	1,138	179	13	0	33	109	91	16	23	1,505
Water Year Types ^c												
Wet (32%)	2,674	2,857	746	41	-3	1	6	58	65	31	-63	3,255
Above Normal (16%)	1,506	1,706	1,257	140	-5	-5	16	114	39	23	50	2,909
Below Normal (13%)	3,045	2,472	1,667	410	37	7	81	194	145	19	-24	-176
Dry (24%)	1,976	2,182	1,535	238	-11	-2	43	124	108	-56	76	102
Critical (15%)	757	725	713	206	88	4	49	112	130	95	139	70
<p>^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.</p> <p>^b Based on the 82-year simulation period.</p> <p>^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.</p> <p>Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.</p>												

Table 6E.B.9.3. Antioch Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	8,269	8,523	6,763	3,320	1,142	771	1,029	1,628	2,192	4,322	5,909	7,163
20%	7,297	7,021	5,403	2,716	676	521	564	1,250	1,960	3,511	5,054	6,677
30%	7,151	6,658	3,210	2,015	462	313	392	922	1,767	3,094	4,825	6,497
40%	6,852	5,310	2,674	1,230	357	262	288	485	1,514	2,268	3,930	5,981
50%	6,136	2,127	2,179	1,030	289	241	250	356	1,150	1,863	3,459	5,157
60%	1,944	1,839	1,814	430	264	232	232	281	974	1,303	3,247	2,247
70%	797	774	712	261	238	223	225	238	667	1,153	3,035	1,414
80%	745	678	437	234	224	214	219	221	406	1,057	2,812	1,322
90%	655	621	231	215	212	200	213	200	209	829	2,632	1,219
Long Term												
Full Simulation Period ^b	4,357	3,817	2,769	1,427	569	384	449	722	1,384	2,278	3,917	4,173
Water Year Types ^c												
Wet (32%)	2,942	2,175	861	374	241	221	223	241	545	919	2,804	1,244
Above Normal (16%)	5,638	4,065	2,362	727	275	225	233	298	963	1,247	2,878	2,243
Below Normal (13%)	3,018	2,846	2,728	1,564	576	397	430	669	1,448	1,961	3,512	5,704
Dry (24%)	4,693	4,494	3,908	2,128	741	403	471	830	1,609	3,290	4,892	6,457
Critical (15%)	6,705	6,865	5,485	3,174	1,303	867	1,153	2,093	3,225	4,943	6,200	7,400
Alternative 5												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	8,310	8,347	6,774	3,316	1,168	776	809	1,248	2,079	4,277	5,950	7,261
20%	7,429	7,056	5,276	2,730	676	521	514	934	1,839	3,441	5,107	6,724
30%	7,180	6,651	3,218	2,018	474	314	354	729	1,708	3,068	4,899	6,540
40%	6,806	5,293	2,673	1,230	357	262	283	454	1,445	2,272	3,917	5,998
50%	6,010	2,123	2,185	1,029	290	241	250	337	1,119	1,868	3,442	5,041
60%	1,945	1,828	1,814	429	263	231	235	279	970	1,306	3,246	2,250
70%	791	774	746	261	238	222	225	238	674	1,162	3,014	1,421
80%	740	678	389	235	224	213	219	223	409	1,057	2,762	1,317
90%	655	619	230	215	212	200	213	200	209	841	2,603	1,219
Long Term												
Full Simulation Period ^b	4,354	3,805	2,775	1,450	584	385	402	613	1,315	2,254	3,907	4,172
Water Year Types ^c												
Wet (32%)	2,940	2,202	867	374	242	221	223	237	545	911	2,774	1,242
Above Normal (16%)	5,635	3,991	2,336	725	275	225	233	295	961	1,248	2,876	2,248
Below Normal (13%)	3,027	2,852	2,730	1,567	576	397	390	580	1,424	1,957	3,488	5,658
Dry (24%)	4,687	4,467	3,935	2,152	746	404	404	692	1,547	3,278	4,902	6,474
Critical (15%)	6,688	6,848	5,494	3,292	1,395	876	982	1,673	2,877	4,821	6,202	7,403
Alternative 5 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	41	-175	10	-5	26	5	-220	-380	-113	-46	41	98
20%	132	35	-127	14	0	0	-49	-317	-121	-70	54	47
30%	29	-7	8	2	13	0	-37	-194	-60	-26	73	43
40%	-46	-16	0	-1	0	0	-5	-31	-69	4	-13	17
50%	-126	-4	6	-1	0	0	0	-20	-32	5	-17	-116
60%	1	-10	0	-1	-1	0	2	-2	-4	3	-1	3
70%	-6	0	34	0	0	-1	1	0	7	9	-20	7
80%	-5	0	-49	1	0	-1	0	2	3	0	-50	-5
90%	0	-2	-1	0	0	0	0	0	0	12	-29	0
Long Term												
Full Simulation Period ^b	-4	-12	6	23	15	2	-47	-109	-69	-24	-10	-1
Water Year Types ^c												
Wet (32%)	-2	27	5	0	0	0	0	-4	0	-8	-31	-2
Above Normal (16%)	-3	-75	-26	-2	0	0	1	-2	-2	1	-2	5
Below Normal (13%)	9	6	1	3	-1	-1	-41	-89	-24	-4	-24	-46
Dry (24%)	-6	-27	28	24	5	1	-67	-137	-61	-12	11	17
Critical (15%)	-17	-17	9	118	92	9	-171	-420	-348	-122	2	3

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.9.4. Antioch Salinity, Monthly EC

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	8,123	8,439	6,868	4,639	1,903	1,120	1,205	1,726	2,229	4,336	6,230	7,278
20%	7,156	7,100	6,677	3,967	1,113	581	751	1,252	1,947	3,509	5,312	6,895
30%	6,985	6,934	6,276	3,125	748	361	563	1,154	1,625	3,100	4,945	6,407
40%	6,786	6,677	5,659	1,885	489	298	402	676	1,283	2,177	4,198	6,066
50%	6,571	6,439	4,473	1,391	345	255	302	497	1,039	1,890	3,486	5,666
60%	6,439	6,067	2,944	784	269	238	242	371	893	1,398	3,302	5,393
70%	6,203	5,888	1,546	292	242	227	220	278	730	1,281	3,112	5,241
80%	5,892	5,219	989	238	219	214	210	203	456	1,058	2,936	5,022
90%	4,839	2,042	438	215	210	199	205	190	208	853	2,670	4,657
Long Term												
Full Simulation Period ^b	6,379	5,877	4,016	1,934	755	454	513	821	1,354	2,307	4,038	5,739
Water Year Types ^c												
Wet (32%)	5,652	4,968	1,663	482	248	222	231	277	510	969	2,846	4,539
Above Normal (16%)	6,900	5,688	3,849	1,169	338	228	255	394	864	1,288	3,015	5,204
Below Normal (13%)	5,956	5,206	4,384	2,752	1,026	505	550	839	1,245	2,015	3,765	5,818
Dry (24%)	6,661	6,582	5,503	2,942	1,004	481	560	933	1,607	3,240	5,044	6,588
Critical (15%)	7,307	7,494	6,481	3,480	1,639	1,112	1,291	2,258	3,390	5,021	6,298	7,433

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance ^a												
10%	8,269	8,523	6,763	3,320	1,142	771	1,029	1,628	2,192	4,322	5,909	7,163
20%	7,297	7,021	5,403	2,716	676	521	564	1,250	1,960	3,511	5,054	6,677
30%	7,151	6,658	3,210	2,015	462	313	392	922	1,767	3,094	4,825	6,497
40%	6,852	5,310	2,674	1,230	357	262	288	485	1,514	2,268	3,930	5,981
50%	6,136	2,127	2,179	1,030	289	241	250	356	1,150	1,863	3,459	5,157
60%	1,944	1,839	1,814	430	264	232	232	281	974	1,303	3,247	2,247
70%	797	774	712	261	238	223	225	238	667	1,153	3,035	1,414
80%	745	678	437	234	224	214	219	221	406	1,057	2,812	1,322
90%	655	621	231	215	212	200	213	200	209	829	2,632	1,219
Long Term												
Full Simulation Period ^b	4,357	3,817	2,769	1,427	569	384	449	722	1,384	2,278	3,917	4,173
Water Year Types ^c												
Wet (32%)	2,942	2,175	861	374	241	221	223	241	545	919	2,804	1,244
Above Normal (16%)	5,638	4,065	2,362	727	275	225	233	298	963	1,247	2,878	2,243
Below Normal (13%)	3,018	2,846	2,728	1,564	576	397	430	669	1,448	1,961	3,512	5,704
Dry (24%)	4,693	4,494	3,908	2,128	741	403	471	830	1,609	3,290	4,892	6,457
Critical (15%)	6,705	6,865	5,485	3,174	1,303	867	1,153	2,093	3,225	4,943	6,200	7,400

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative minus Second Basis of Comparison												
Probability of Exceedance ^a												
10%	147	84	-104	-1,318	-760	-349	-177	-98	-36	-13	-321	-115
20%	141	-79	-1,274	-1,251	-437	-60	-187	-2	13	2	-258	-218
30%	166	-276	-3,067	-1,110	-287	-47	-171	-231	143	-5	-119	90
40%	66	-1,367	-2,985	-655	-132	-36	-114	-191	231	91	-268	-85
50%	-435	-4,312	-2,294	-362	-56	-14	-52	-141	111	-27	-27	-509
60%	-4,495	-4,228	-1,131	-354	-5	-6	-10	-90	82	-94	-55	-3,146
70%	-5,406	-5,115	-835	-31	-4	-4	5	-39	-64	-128	-78	-3,827
80%	-5,147	-4,540	-552	-4	5	1	9	18	-50	-1	-124	-3,700
90%	-4,184	-1,422	-206	0	2	1	8	10	1	-24	-38	-3,438
Long Term												
Full Simulation Period ^b	-2,022	-2,061	-1,247	-507	-186	-70	-64	-99	30	-29	-121	-1,566
Water Year Types ^c												
Wet (32%)	-2,709	-2,793	-802	-108	-7	-1	-9	-36	36	-50	-42	-3,295
Above Normal (16%)	-1,262	-1,622	-1,488	-442	-64	-4	-22	-96	99	-42	-138	-2,961
Below Normal (13%)	-2,938	-2,360	-1,656	-1,188	-449	-107	-120	-170	203	-54	-253	-114
Dry (24%)	-1,968	-2,088	-1,595	-813	-262	-79	-89	-103	2	50	-153	-132
Critical (15%)	-603	-629	-996	-306	-336	-245	-138	-164	-166	-78	-98	-32

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.9.5. Antioch Salinity, Monthly EC

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	8,123	8,439	6,868	4,639	1,903	1,120	1,205	1,726	2,229	4,336	6,230	7,278
20%	7,156	7,100	6,677	3,967	1,113	581	751	1,252	1,947	3,509	5,312	6,895
30%	6,985	6,934	6,276	3,125	748	361	563	1,154	1,625	3,100	4,945	6,407
40%	6,786	6,677	5,659	1,885	489	298	402	676	1,283	2,177	4,198	6,066
50%	6,571	6,439	4,473	1,391	345	255	302	497	1,039	1,890	3,486	5,666
60%	6,439	6,067	2,944	784	269	238	242	371	893	1,398	3,302	5,393
70%	6,203	5,888	1,546	292	242	227	220	278	730	1,281	3,112	5,241
80%	5,892	5,219	989	238	219	214	210	203	456	1,058	2,936	5,022
90%	4,839	2,042	438	215	210	199	205	190	208	853	2,670	4,657
Long Term												
Full Simulation Period ^b	6,379	5,877	4,016	1,934	755	454	513	821	1,354	2,307	4,038	5,739
Water Year Types ^c												
Wet (32%)	5,652	4,968	1,663	482	248	222	231	277	510	969	2,846	4,539
Above Normal (16%)	6,900	5,688	3,849	1,169	338	228	255	394	864	1,288	3,015	5,204
Below Normal (13%)	5,956	5,206	4,384	2,752	1,026	505	550	839	1,245	2,015	3,765	5,818
Dry (24%)	6,661	6,582	5,503	2,942	1,004	481	560	933	1,607	3,240	5,044	6,588
Critical (15%)	7,307	7,494	6,481	3,480	1,639	1,112	1,291	2,258	3,390	5,021	6,298	7,433

Alternative 3

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	8,118	8,539	6,862	3,812	1,184	752	1,013	1,802	2,292	4,016	5,977	7,286
20%	7,295	7,260	6,644	3,146	683	530	695	1,327	2,027	3,511	5,322	6,834
30%	7,057	6,924	6,126	2,499	470	300	502	1,056	1,846	3,116	4,744	6,466
40%	6,798	6,757	5,238	1,413	345	259	361	742	1,566	2,128	3,948	5,868
50%	6,576	6,468	4,459	1,027	287	242	298	571	1,240	1,929	3,389	5,510
60%	6,325	6,142	2,942	511	261	231	242	421	1,025	1,334	3,240	5,284
70%	6,176	5,841	1,343	269	239	220	217	281	808	1,175	2,910	5,068
80%	5,918	5,120	997	237	222	212	210	205	525	1,098	2,860	4,930
90%	5,223	2,265	488	223	210	199	203	189	218	856	2,585	4,796
Long Term												
Full Simulation Period ^b	6,445	5,963	3,907	1,606	582	384	482	831	1,476	2,294	3,940	5,678
Water Year Types ^c												
Wet (32%)	5,617	5,033	1,607	415	238	221	229	299	610	950	2,741	4,498
Above Normal (16%)	7,143	5,772	3,619	868	270	220	248	412	1,002	1,270	2,928	5,152
Below Normal (13%)	6,062	5,318	4,395	1,974	614	404	512	863	1,593	1,980	3,488	5,527
Dry (24%)	6,669	6,676	5,442	2,367	731	400	514	954	1,716	3,234	4,967	6,559
Critical (15%)	7,462	7,590	6,198	3,380	1,391	871	1,202	2,205	3,354	5,038	6,338	7,470

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-5	100	-6	-827	-718	-368	-193	77	63	-320	-253	8
20%	139	160	-33	-821	-430	-51	-56	75	80	2	10	-61
30%	73	-11	-150	-627	-279	-61	-61	-97	221	16	-201	59
40%	12	79	-421	-472	-144	-39	-41	66	284	-49	-250	-199
50%	5	29	-15	-364	-59	-14	-4	74	201	38	-97	-155
60%	-114	75	-2	-273	-7	-7	0	50	132	-63	-62	-109
70%	-27	-47	-203	-23	-3	-6	-2	3	78	-106	-202	-173
80%	25	-99	8	-1	3	-1	-1	2	69	40	-76	-92
90%	384	223	50	8	0	0	-2	0	10	3	-85	138
Long Term												
Full Simulation Period ^b	66	86	-109	-328	-172	-70	-31	10	122	-13	-97	-62
Water Year Types ^c												
Wet (32%)	-35	64	-56	-67	-10	0	-2	22	100	-19	-105	-40
Above Normal (16%)	243	84	-230	-302	-68	-9	-6	18	139	-18	-88	-52
Below Normal (13%)	106	112	11	-779	-412	-100	-39	24	348	-35	-277	-291
Dry (24%)	8	95	-60	-575	-273	-81	-45	21	109	-6	-77	-29
Critical (15%)	154	96	-283	-100	-248	-241	-89	-53	-36	17	40	38

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.9.6. Antioch Salinity, Monthly EC

Second Basis of Comparison		Monthly EC (UMHOS/CM)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	8,123	8,439	6,868	4,639	1,903	1,120	1,205	1,726	2,229	4,336	6,230	7,278
20%	7,156	7,100	6,677	3,967	1,113	581	751	1,252	1,947	3,509	5,312	6,895
30%	6,985	6,934	6,276	3,125	748	361	563	1,154	1,625	3,100	4,945	6,407
40%	6,786	6,677	5,659	1,885	489	298	402	676	1,283	2,177	4,198	6,066
50%	6,571	6,439	4,473	1,391	345	255	302	497	1,039	1,890	3,486	5,666
60%	6,439	6,067	2,944	784	269	238	242	371	893	1,398	3,302	5,393
70%	6,203	5,888	1,546	292	242	227	220	278	730	1,281	3,112	5,241
80%	5,892	5,219	989	238	219	214	210	203	456	1,058	2,936	5,022
90%	4,839	2,042	438	215	210	199	205	190	208	853	2,670	4,657
Long Term												
Full Simulation Period ^b	6,379	5,877	4,016	1,934	755	454	513	821	1,354	2,307	4,038	5,739
Water Year Types ^c												
Wet (32%)	5,652	4,968	1,663	482	248	222	231	277	510	969	2,846	4,539
Above Normal (16%)	6,900	5,688	3,849	1,169	338	228	255	394	864	1,288	3,015	5,204
Below Normal (13%)	5,956	5,206	4,384	2,752	1,026	505	550	839	1,245	2,015	3,765	5,818
Dry (24%)	6,661	6,582	5,503	2,942	1,004	481	560	933	1,607	3,240	5,044	6,588
Critical (15%)	7,307	7,494	6,481	3,480	1,639	1,112	1,291	2,258	3,390	5,021	6,298	7,433

Alternative 5

Alternative 5		Monthly EC (UMHOS/CM)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	8,310	8,347	6,774	3,316	1,168	776	809	1,248	2,079	4,277	5,950	7,261
20%	7,429	7,056	5,276	2,730	676	521	514	934	1,839	3,441	5,107	6,724
30%	7,180	6,651	3,218	2,018	474	314	354	729	1,708	3,068	4,899	6,540
40%	6,806	5,293	2,673	1,230	357	262	283	454	1,445	2,272	3,917	5,998
50%	6,010	2,123	2,185	1,029	290	241	250	337	1,119	1,868	3,442	5,041
60%	1,945	1,828	1,814	429	263	231	235	279	970	1,306	3,246	2,250
70%	791	774	746	261	238	222	225	238	674	1,162	3,014	1,421
80%	740	678	389	235	224	213	219	223	409	1,057	2,762	1,317
90%	655	619	230	215	212	200	213	200	209	841	2,603	1,219
Long Term												
Full Simulation Period ^b	4,354	3,805	2,775	1,450	584	385	402	613	1,315	2,254	3,907	4,172
Water Year Types ^c												
Wet (32%)	2,940	2,202	867	374	242	221	223	237	545	911	2,774	1,242
Above Normal (16%)	5,635	3,991	2,336	725	275	225	233	295	961	1,248	2,876	2,248
Below Normal (13%)	3,027	2,852	2,730	1,567	576	397	390	580	1,424	1,957	3,488	5,658
Dry (24%)	4,687	4,467	3,935	2,152	746	404	404	692	1,547	3,278	4,902	6,474
Critical (15%)	6,688	6,848	5,494	3,292	1,395	876	982	1,673	2,877	4,821	6,202	7,403

Alternative 5 minus Second Basis of Comparison

Alternative 5 minus Second Basis of Comparison		Monthly EC (UMHOS/CM)										
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	187	-91	-94	-1,323	-735	-344	-397	-478	-149	-59	-280	-17
20%	272	-45	-1,401	-1,237	-437	-60	-237	-318	-108	-68	-205	-171
30%	195	-283	-3,059	-1,108	-274	-47	-208	-425	83	-32	-46	133
40%	20	-1,384	-2,985	-656	-132	-36	-119	-222	162	96	-281	-69
50%	-561	-4,316	-2,288	-362	-56	-14	-52	-161	79	-23	-44	-625
60%	-4,494	-4,238	-1,131	-355	-6	-6	-8	-92	77	-91	-56	-3,142
70%	-5,412	-5,114	-800	-30	-4	-5	6	-40	-57	-119	-98	-3,820
80%	-5,152	-4,540	-600	-4	5	0	9	20	-47	-1	-174	-3,705
90%	-4,184	-1,424	-208	0	2	1	8	10	2	-12	-66	-3,438
Long Term												
Full Simulation Period ^b	-2,025	-2,072	-1,241	-484	-171	-69	-111	-207	-39	-53	-131	-1,568
Water Year Types ^c												
Wet (32%)	-2,711	-2,767	-796	-108	-7	-1	-9	-41	35	-58	-73	-3,297
Above Normal (16%)	-1,265	-1,697	-1,513	-444	-64	-3	-21	-98	98	-40	-140	-2,956
Below Normal (13%)	-2,929	-2,354	-1,655	-1,185	-450	-108	-161	-259	179	-58	-277	-160
Dry (24%)	-1,975	-2,115	-1,567	-789	-257	-78	-156	-241	-60	37	-142	-114
Critical (15%)	-620	-646	-987	-188	-244	-235	-309	-584	-513	-200	-96	-29

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 **B.10.1 Chipps Island North Channel Salinity**

Figure 6E.B.10.1.1. Chipps Island North Channel Salinity, Electrical Conductivity, October

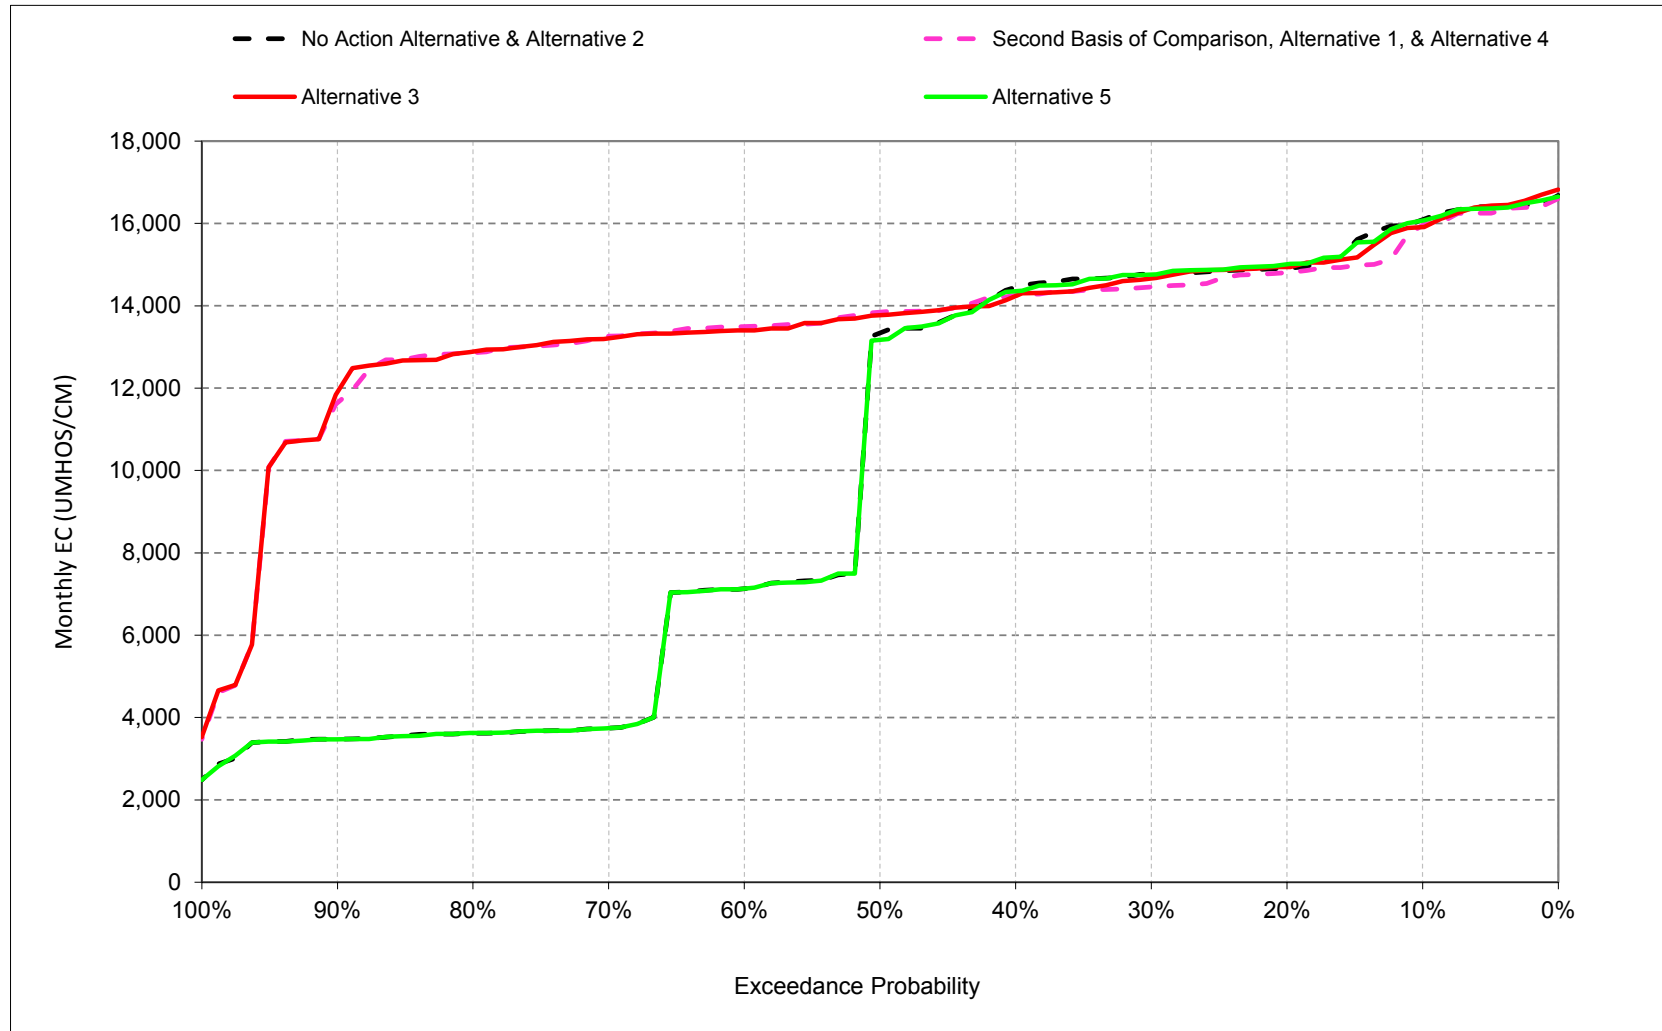


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.10.1.2. Chipps Island North Channel Salinity, Electrical Conductivity, November

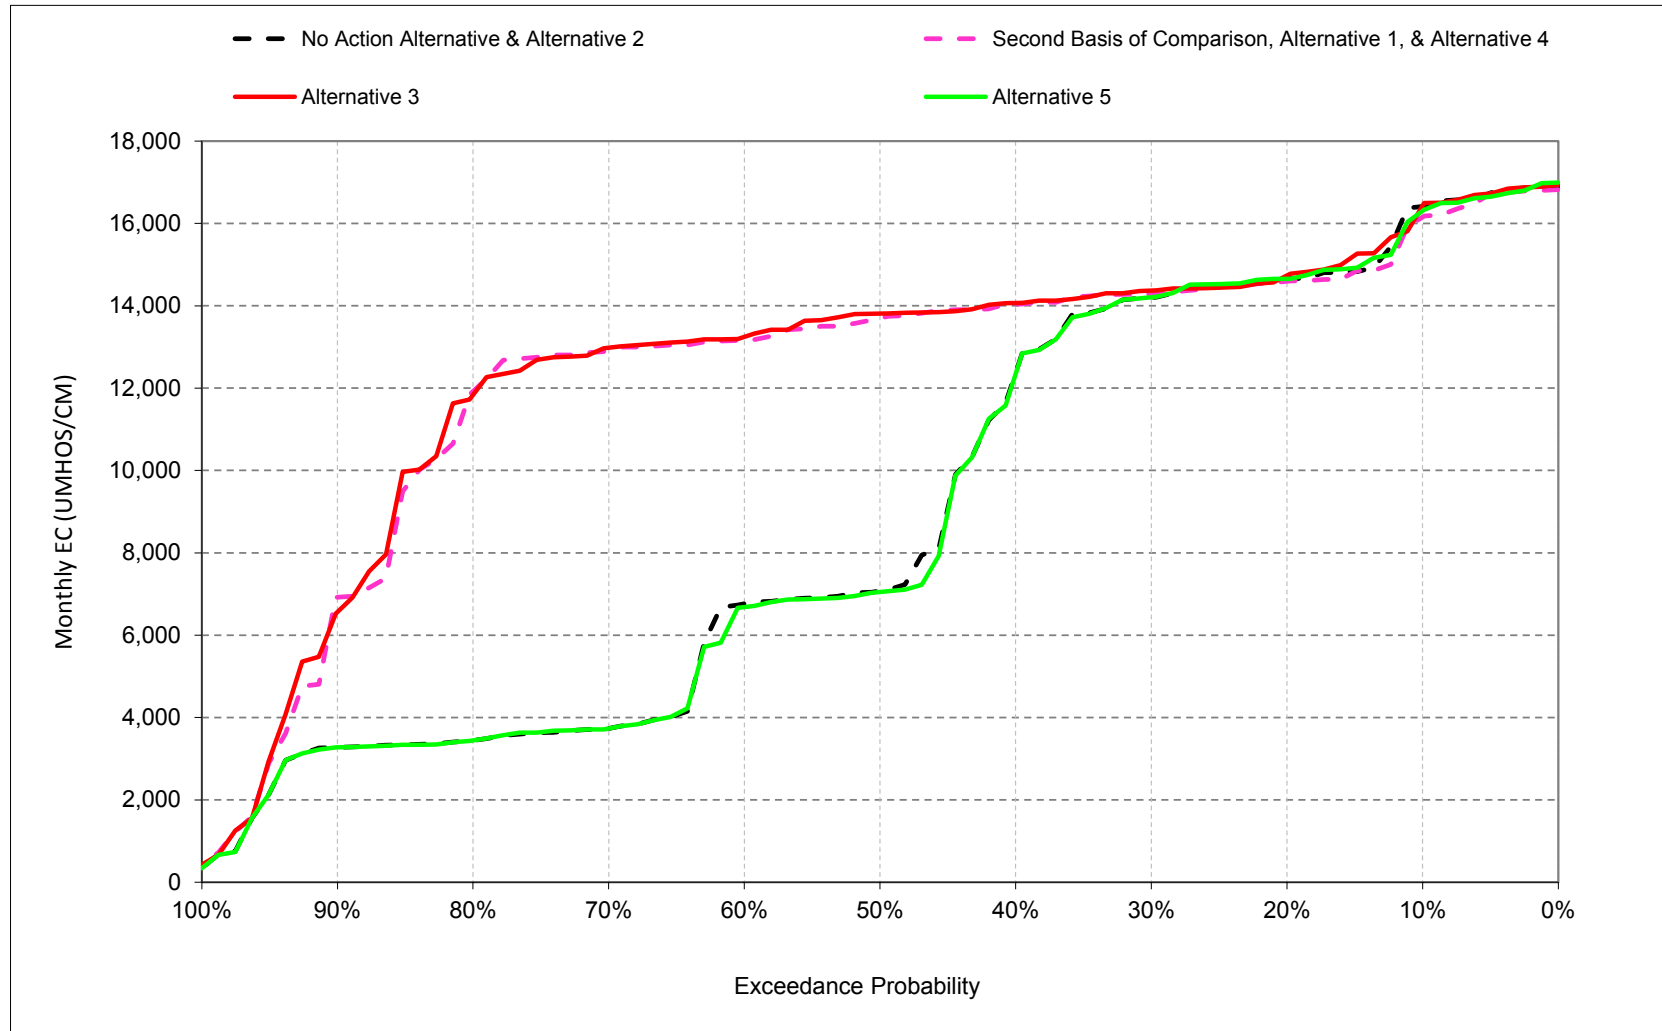


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.10.1.3. Chipps Island North Channel Salinity, Electrical Conductivity, December

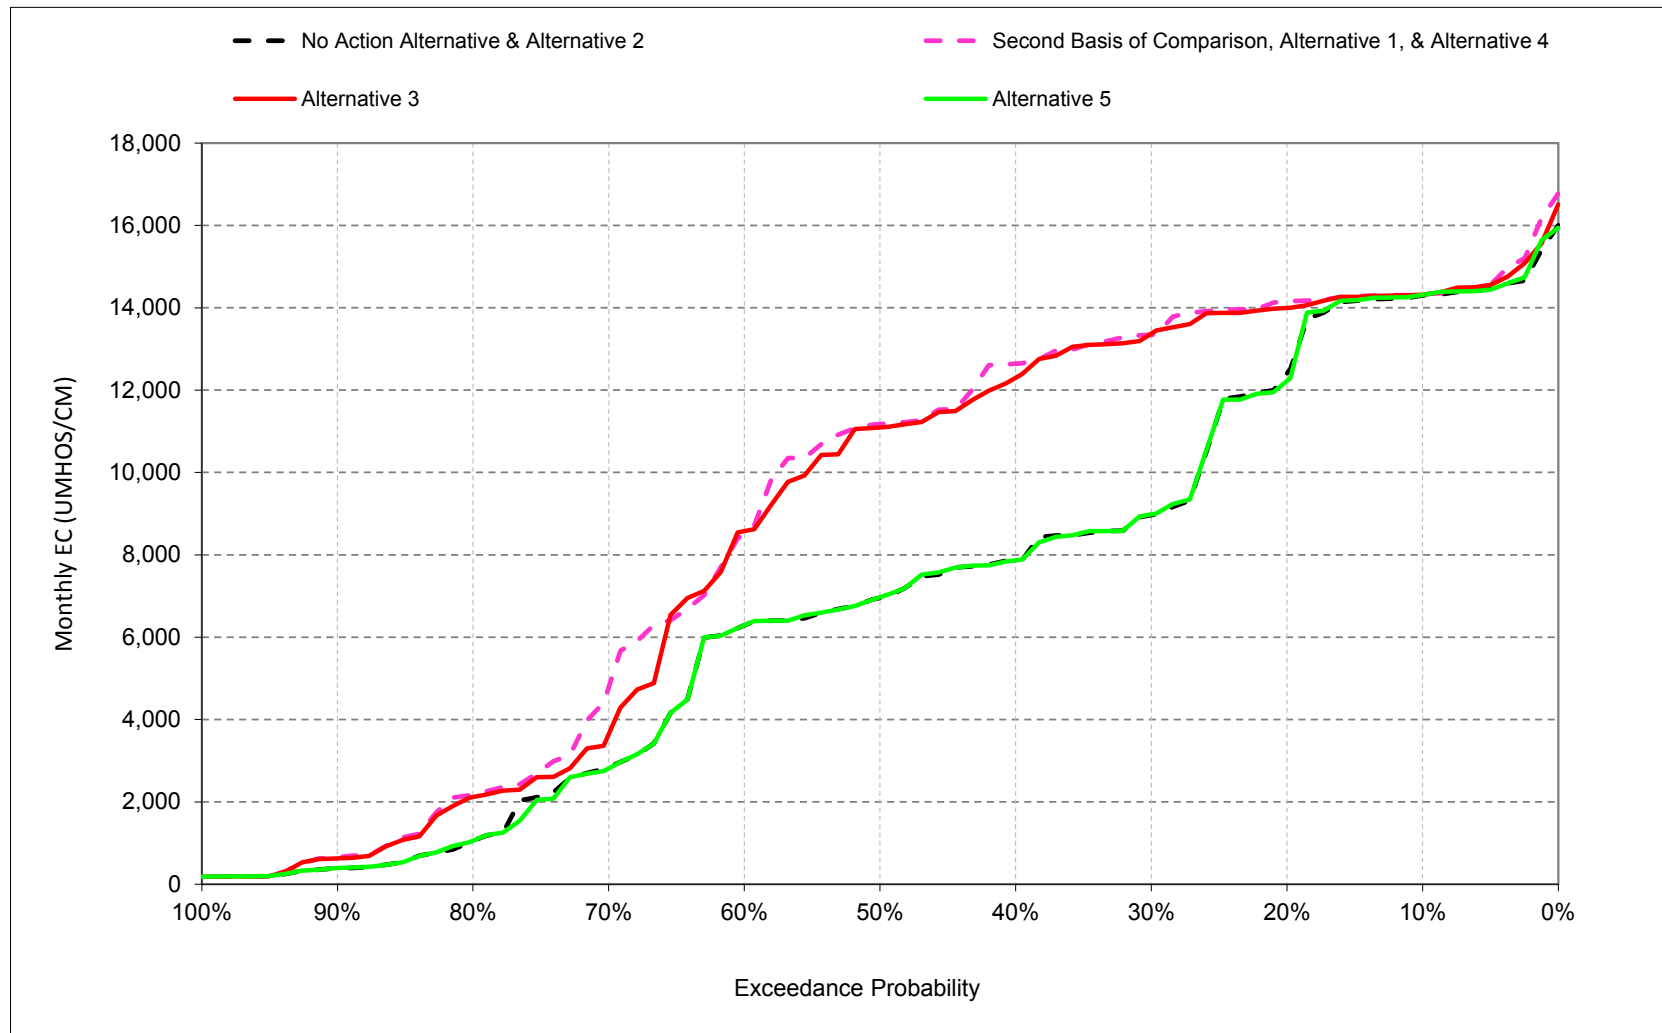


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.10.1.4. Chipps Island North Channel Salinity, Electrical Conductivity, January

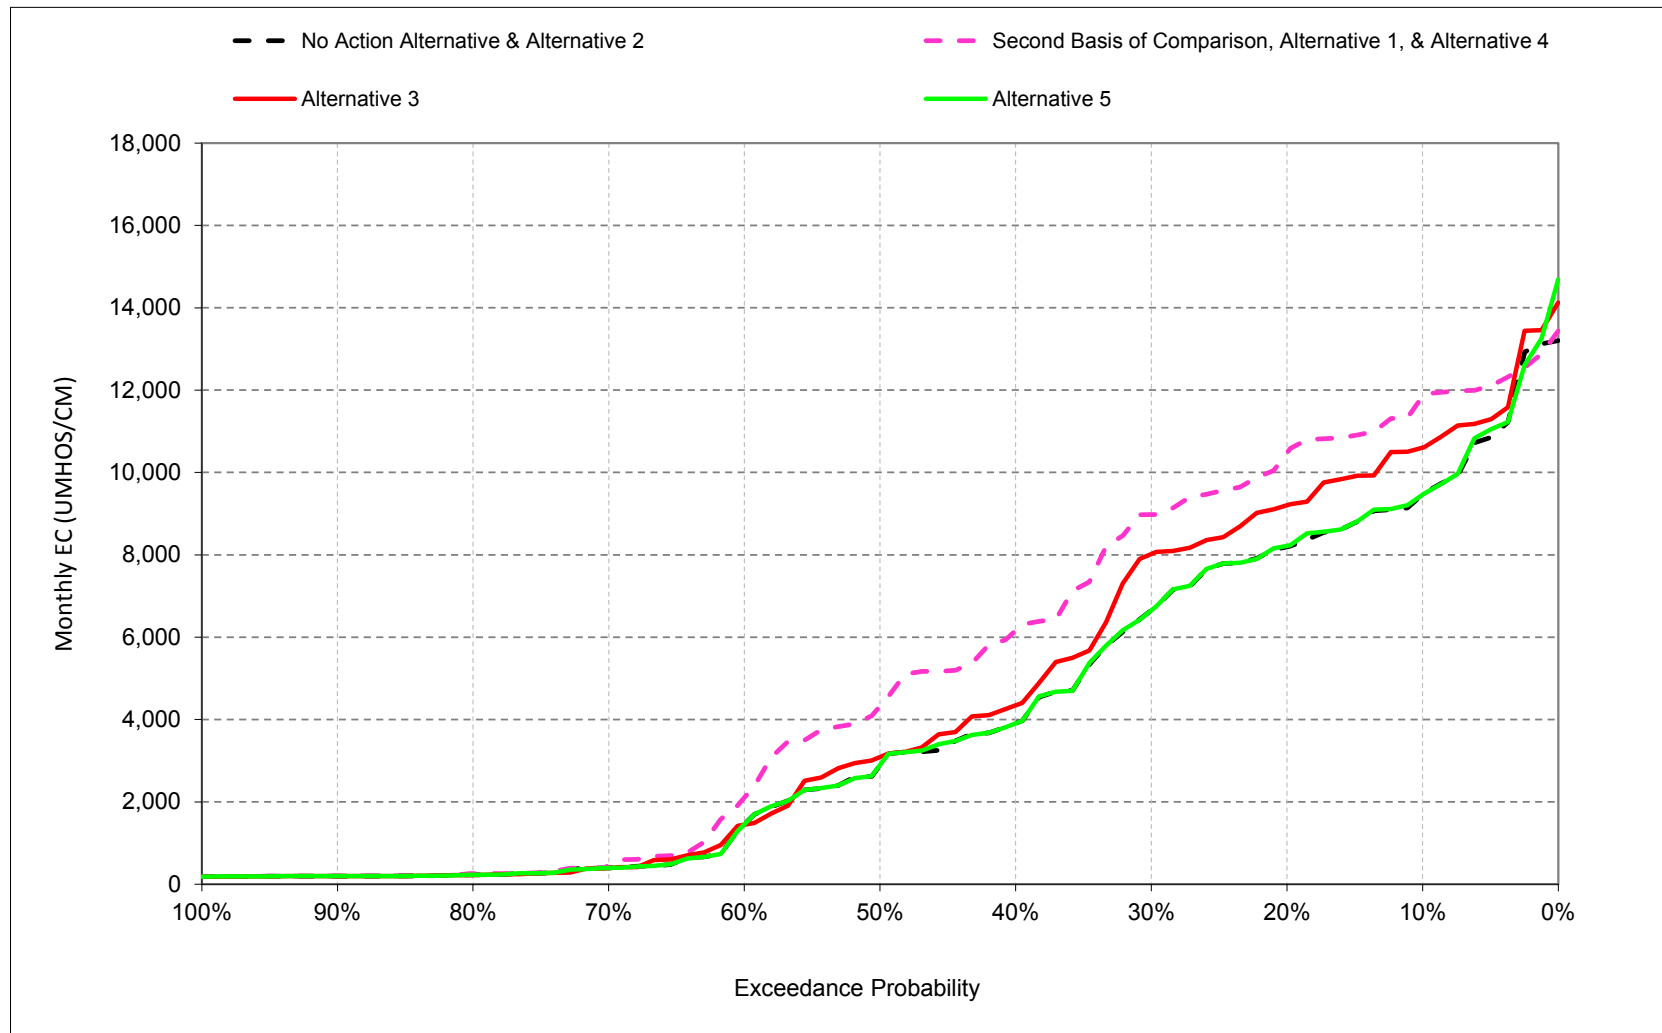


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.10.1.5. Chipps Island North Channel Salinity, Electrical Conductivity, February

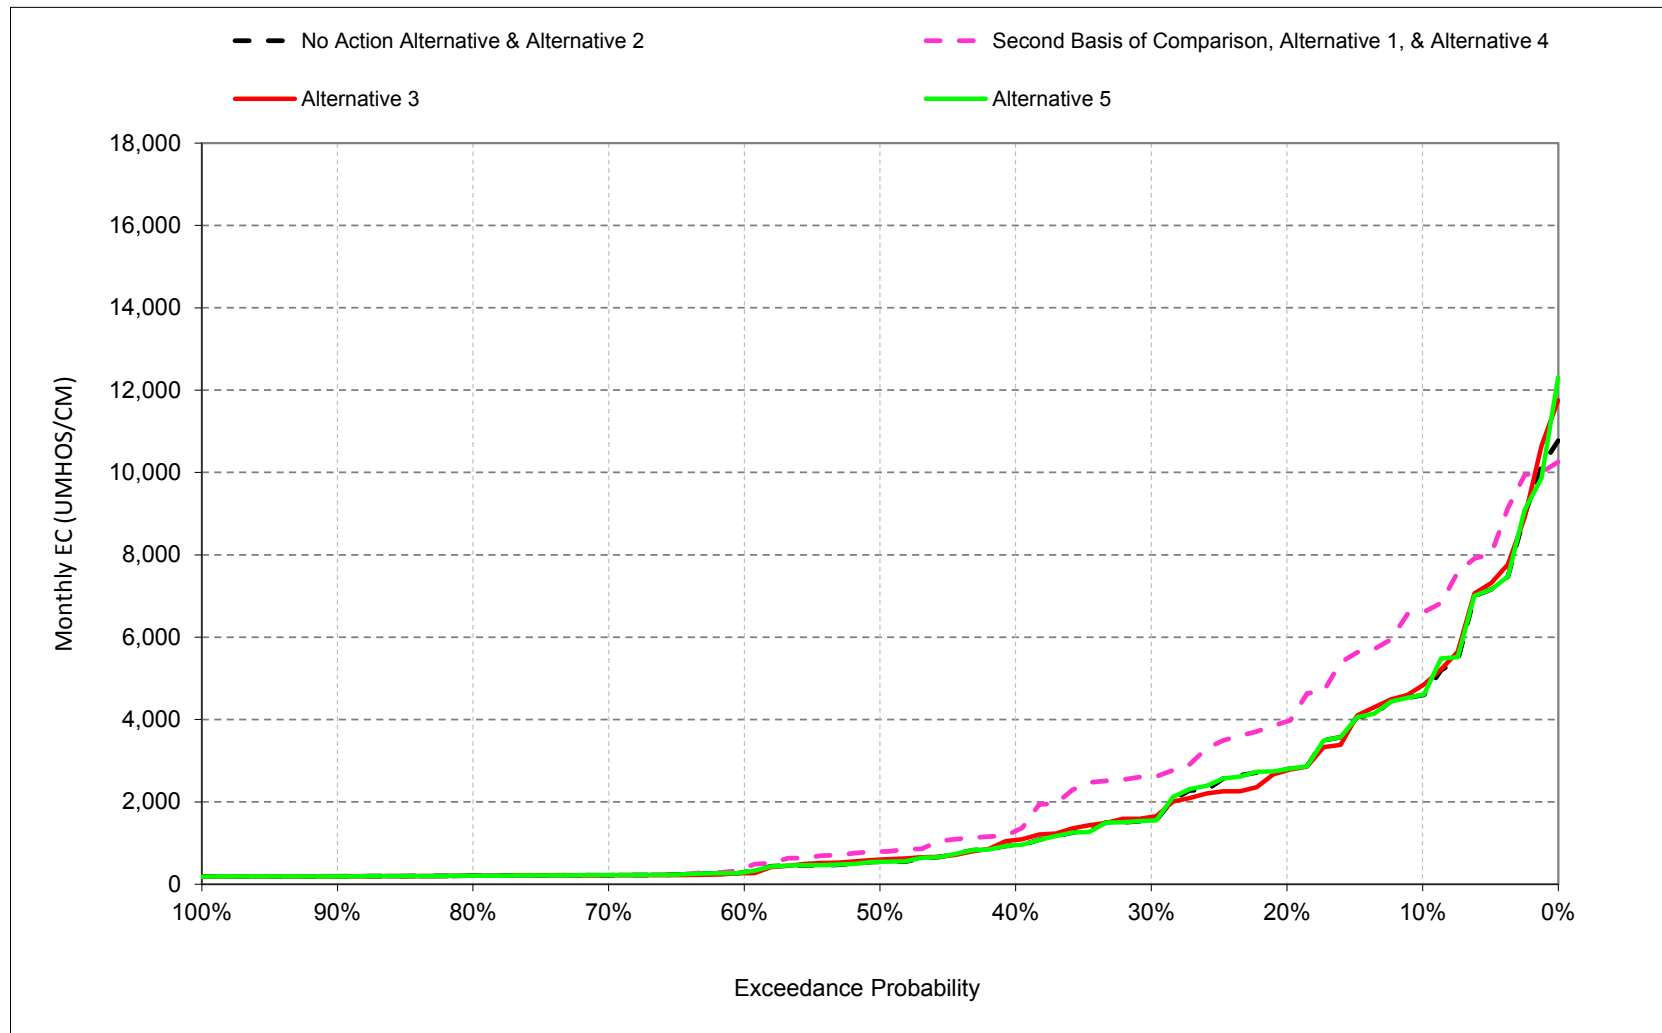


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.10.1.6. Chipps Island North Channel Salinity, Electrical Conductivity, March

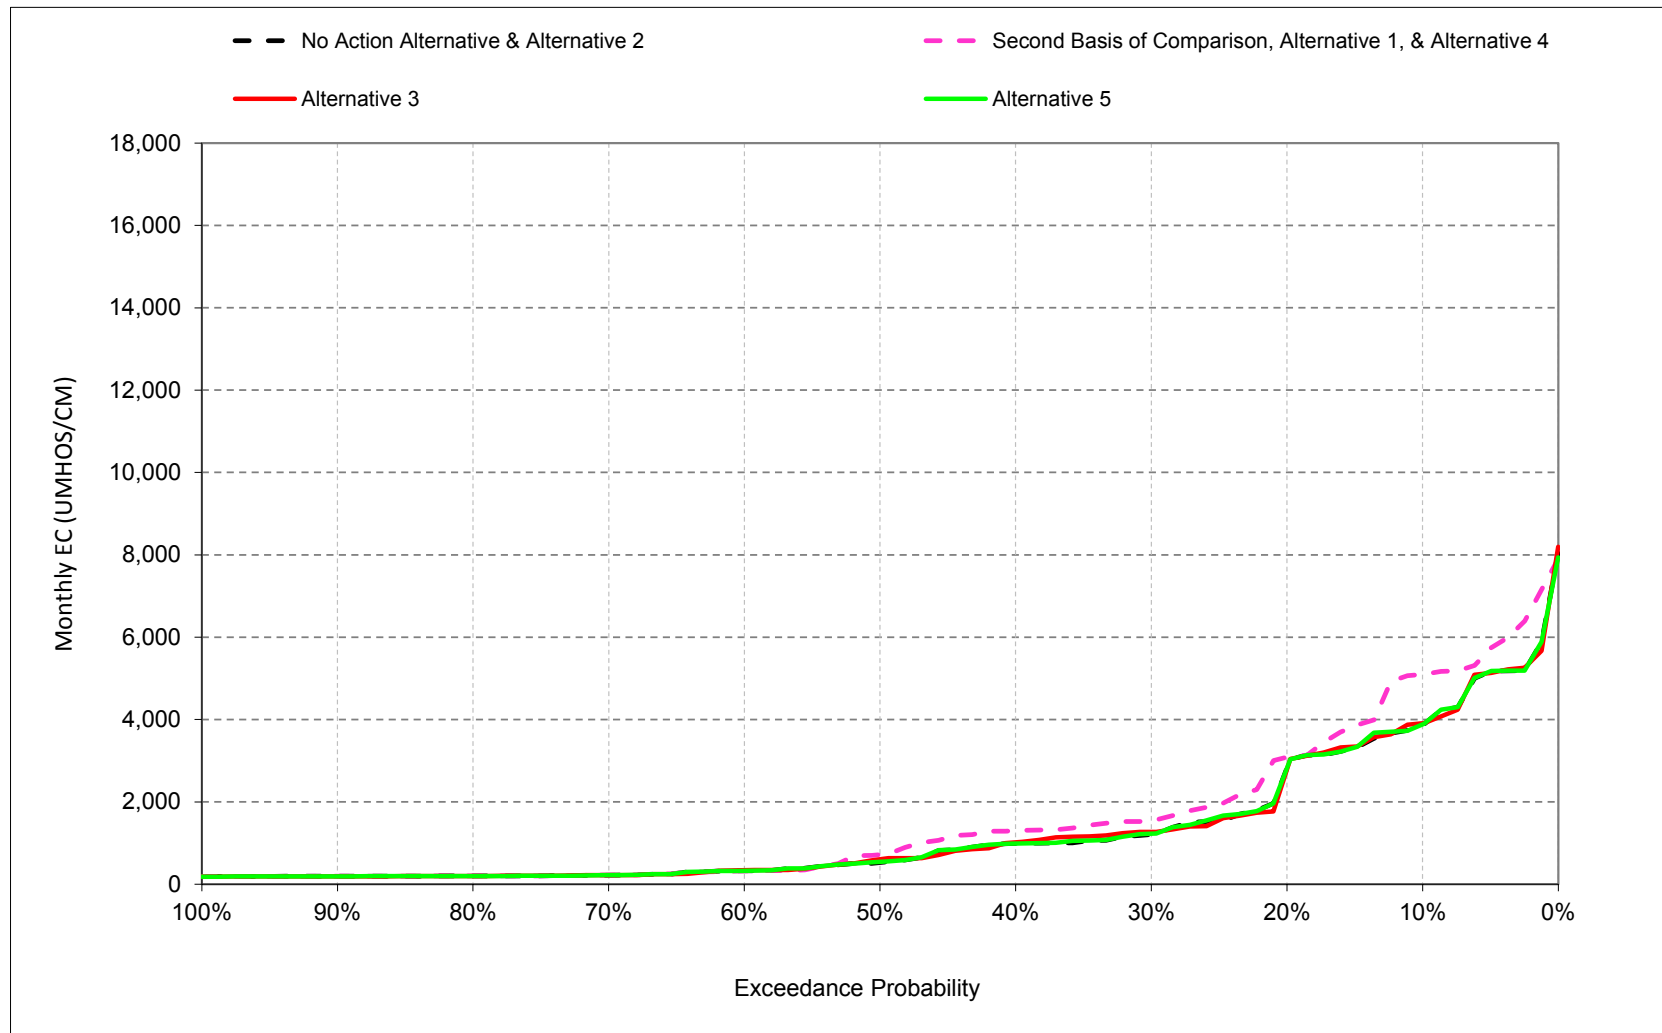


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.10.1.7. Chipps Island North Channel Salinity, Electrical Conductivity, April

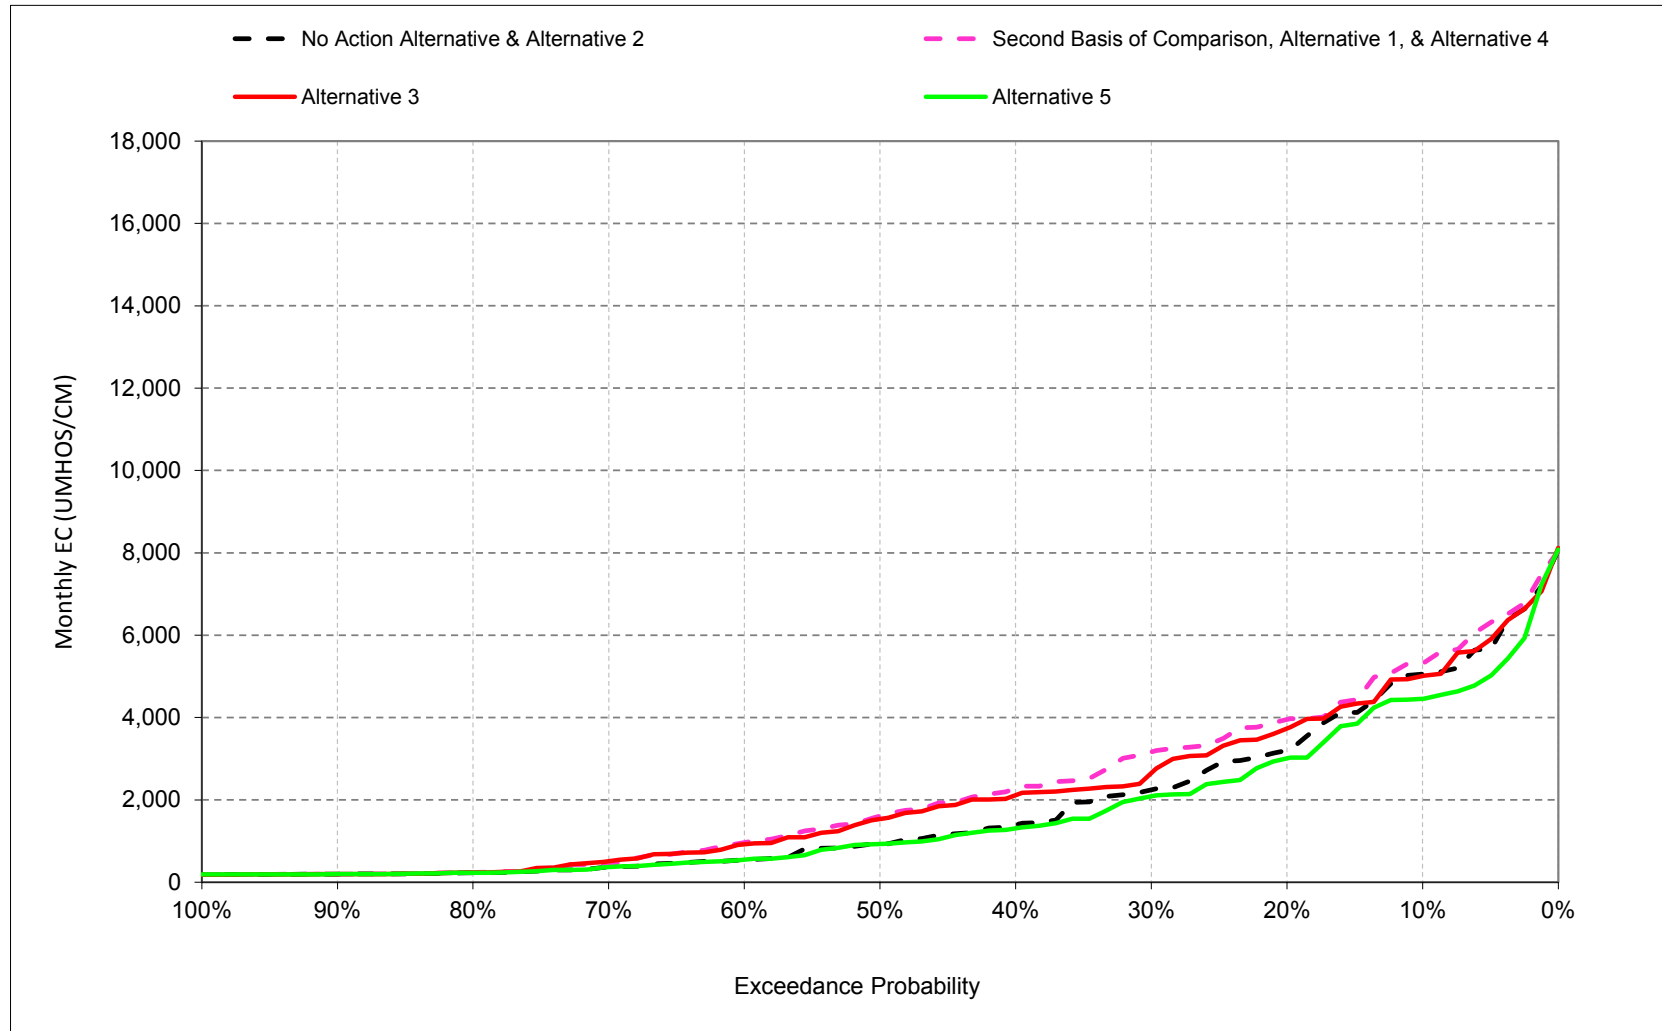


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.10.1.8. Chipps Island North Channel Salinity, Electrical Conductivity, May

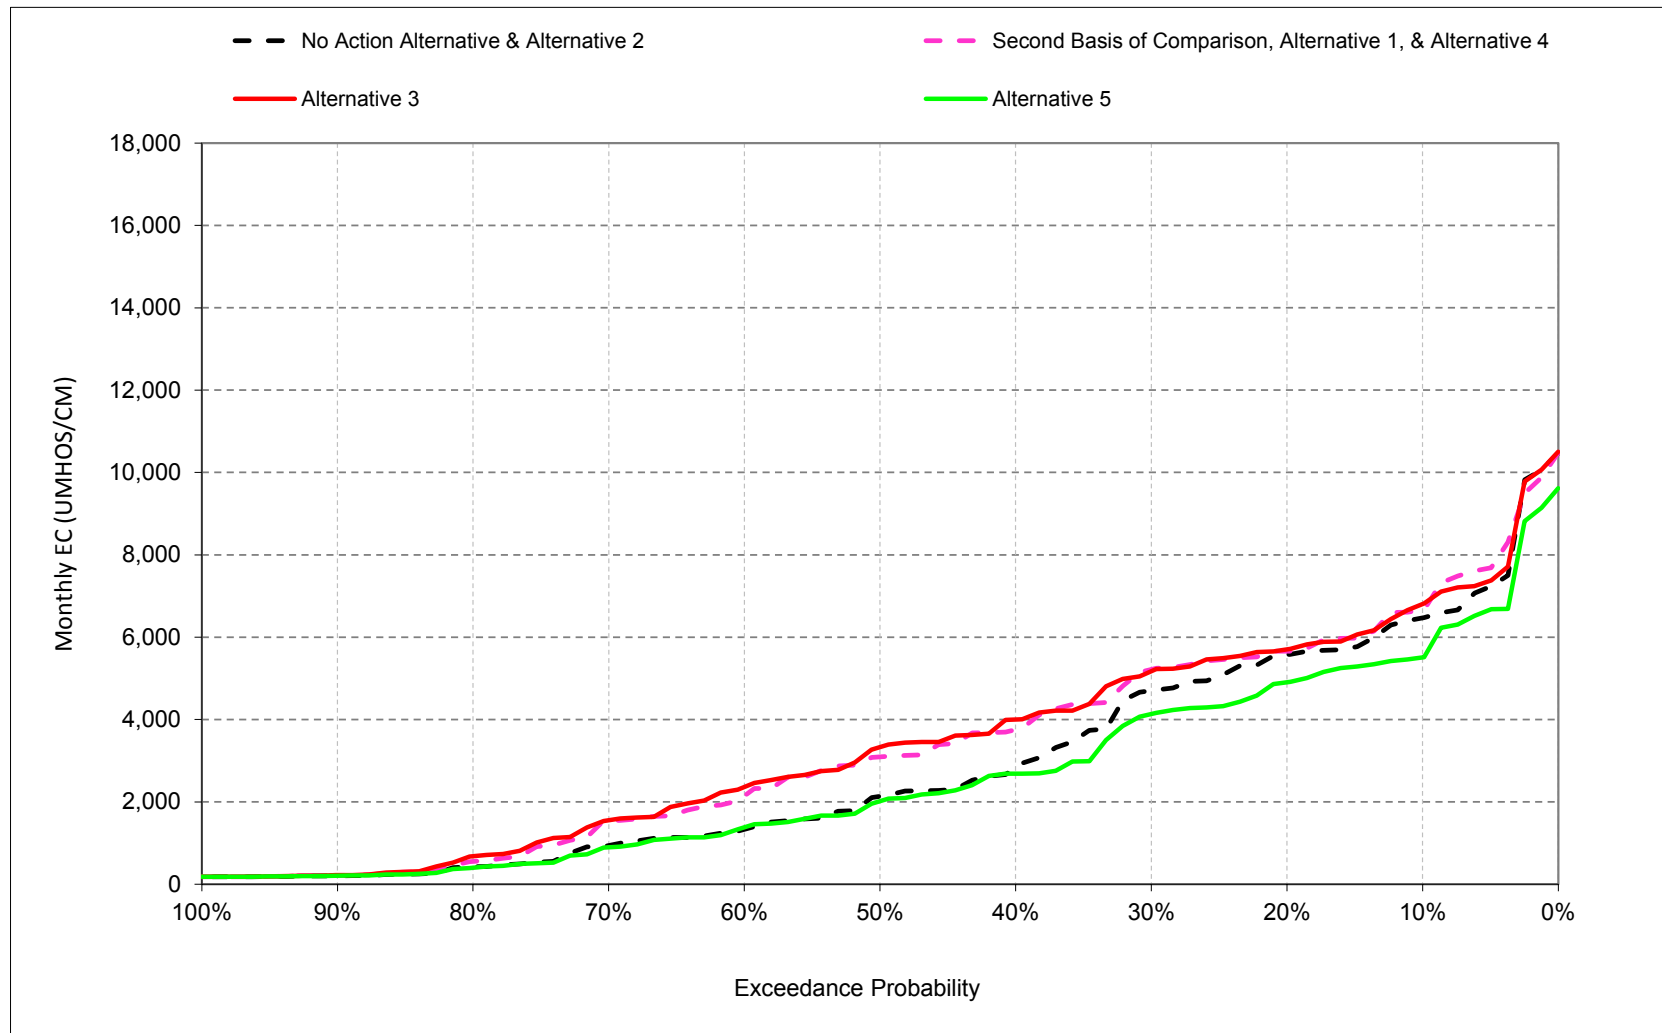


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.10.1.9. Chipps Island North Channel Salinity, Electrical Conductivity, June

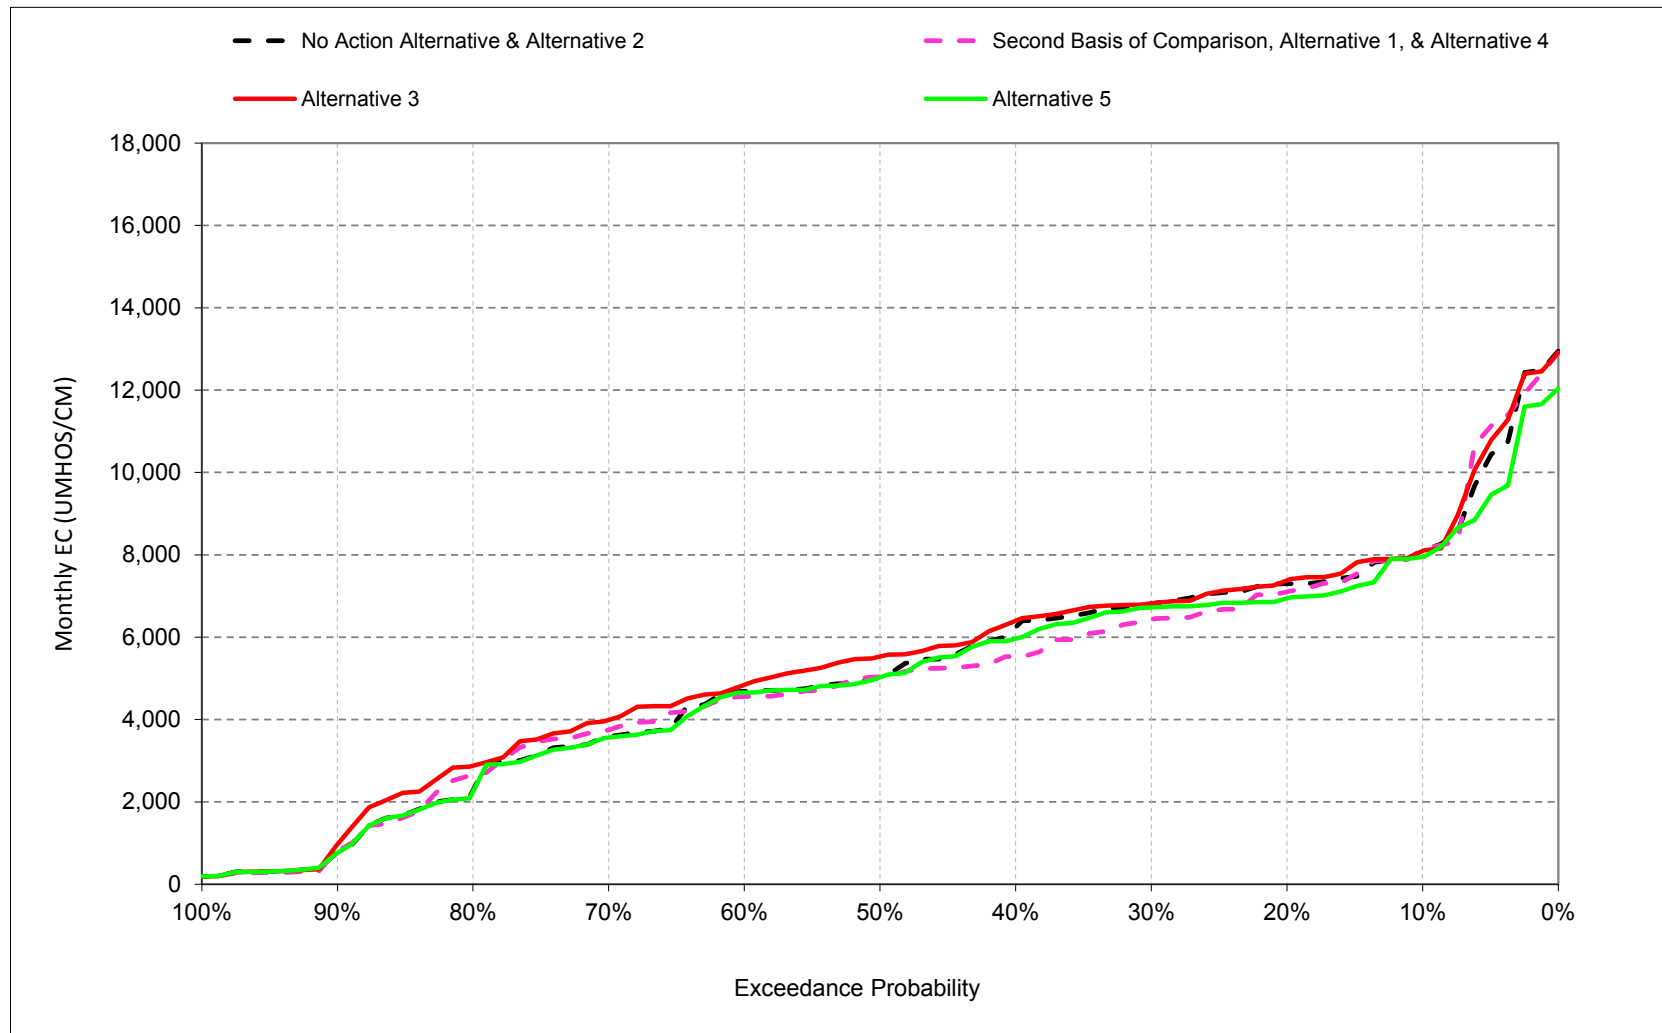


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.10.1.10. Chipps Island North Channel Salinity, Electrical Conductivity, July

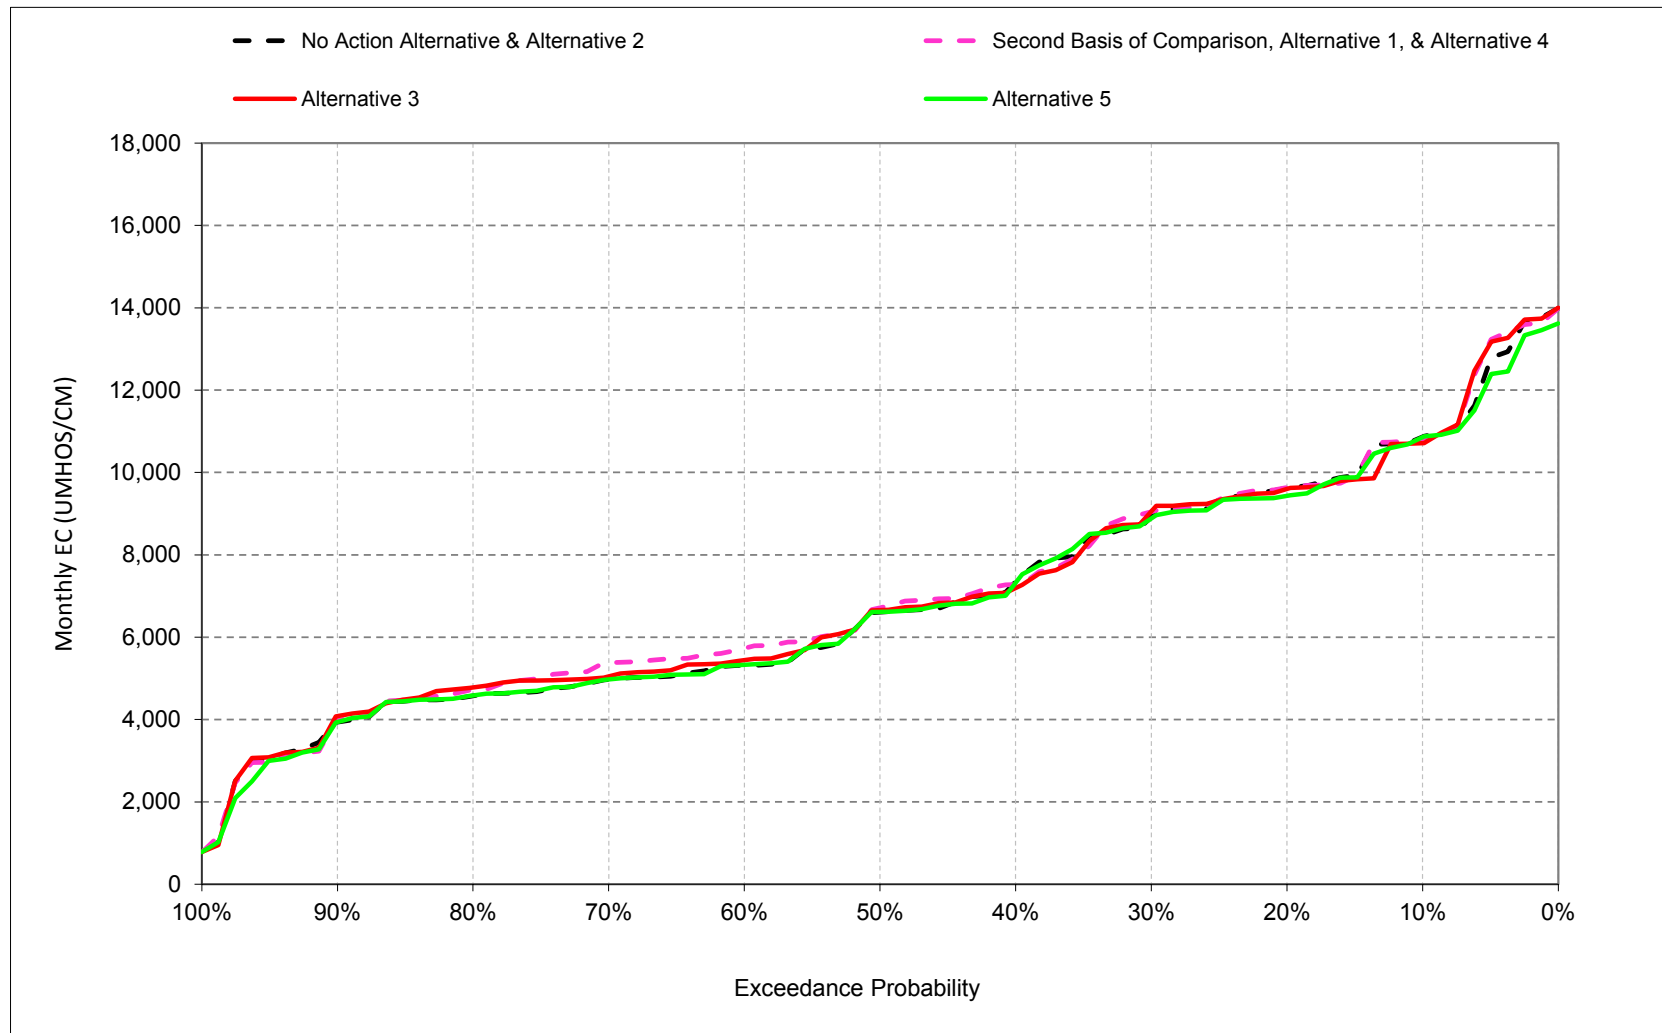


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.10.1.11. Chipps Island North Channel Salinity, Electrical Conductivity, August

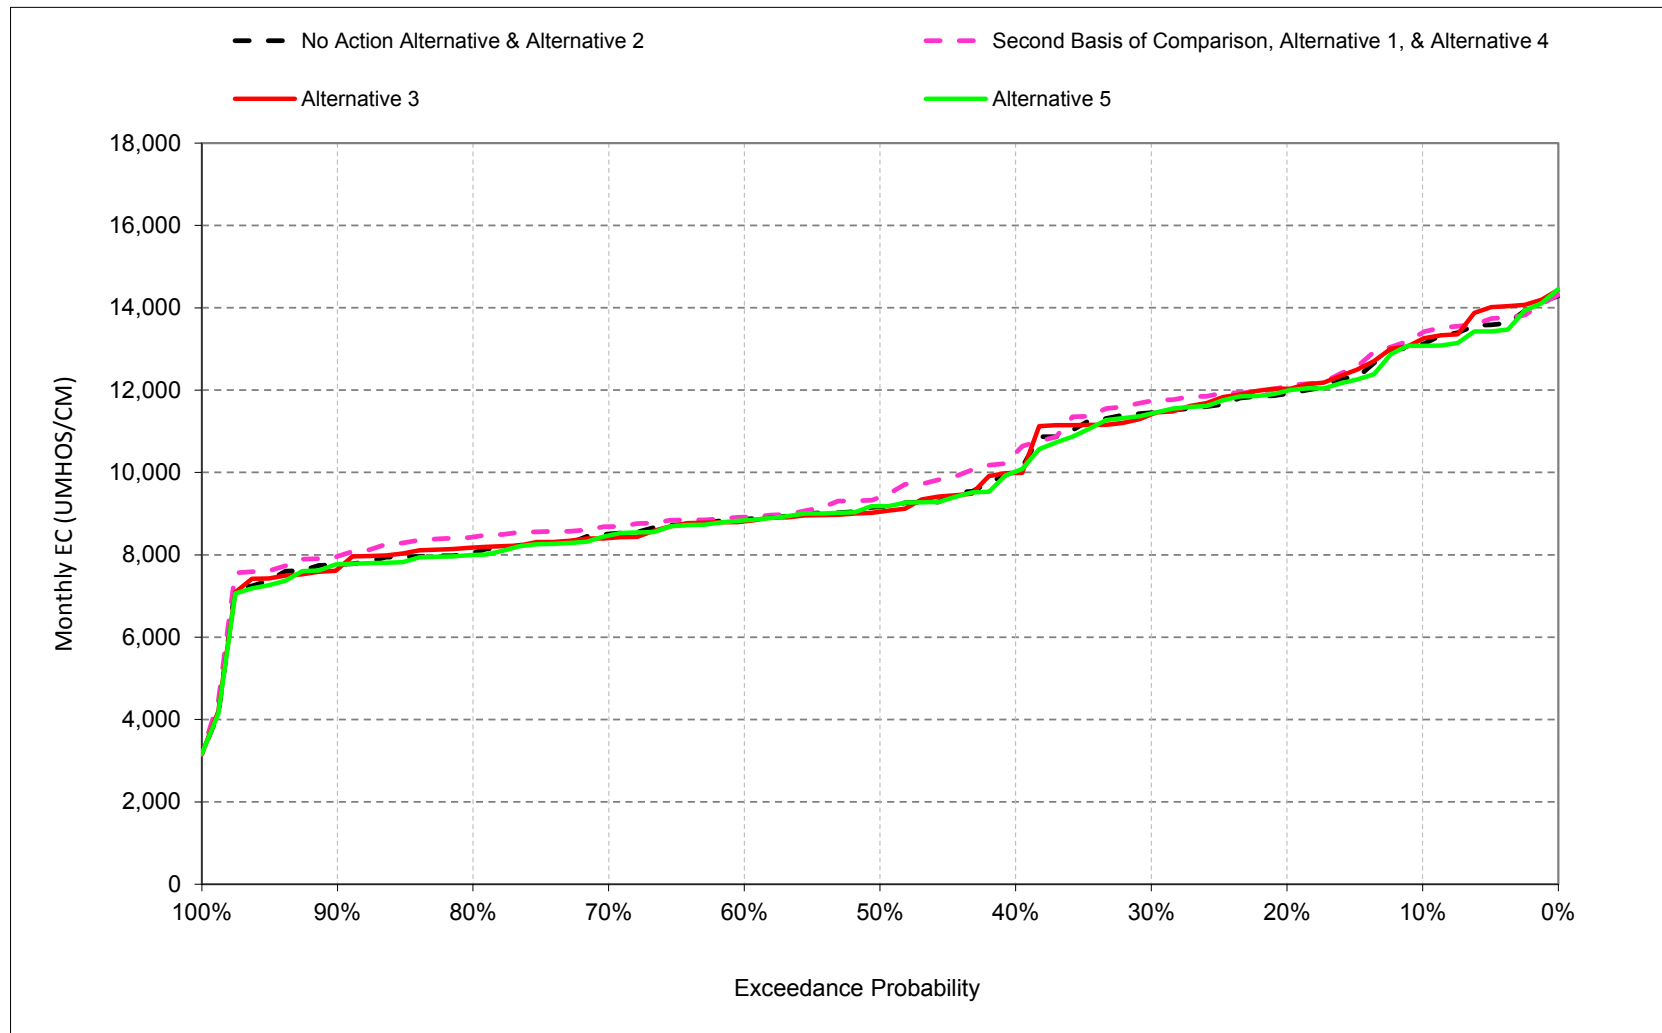

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.10.1.12. Chipps Island North Channel Salinity, Electrical Conductivity, September

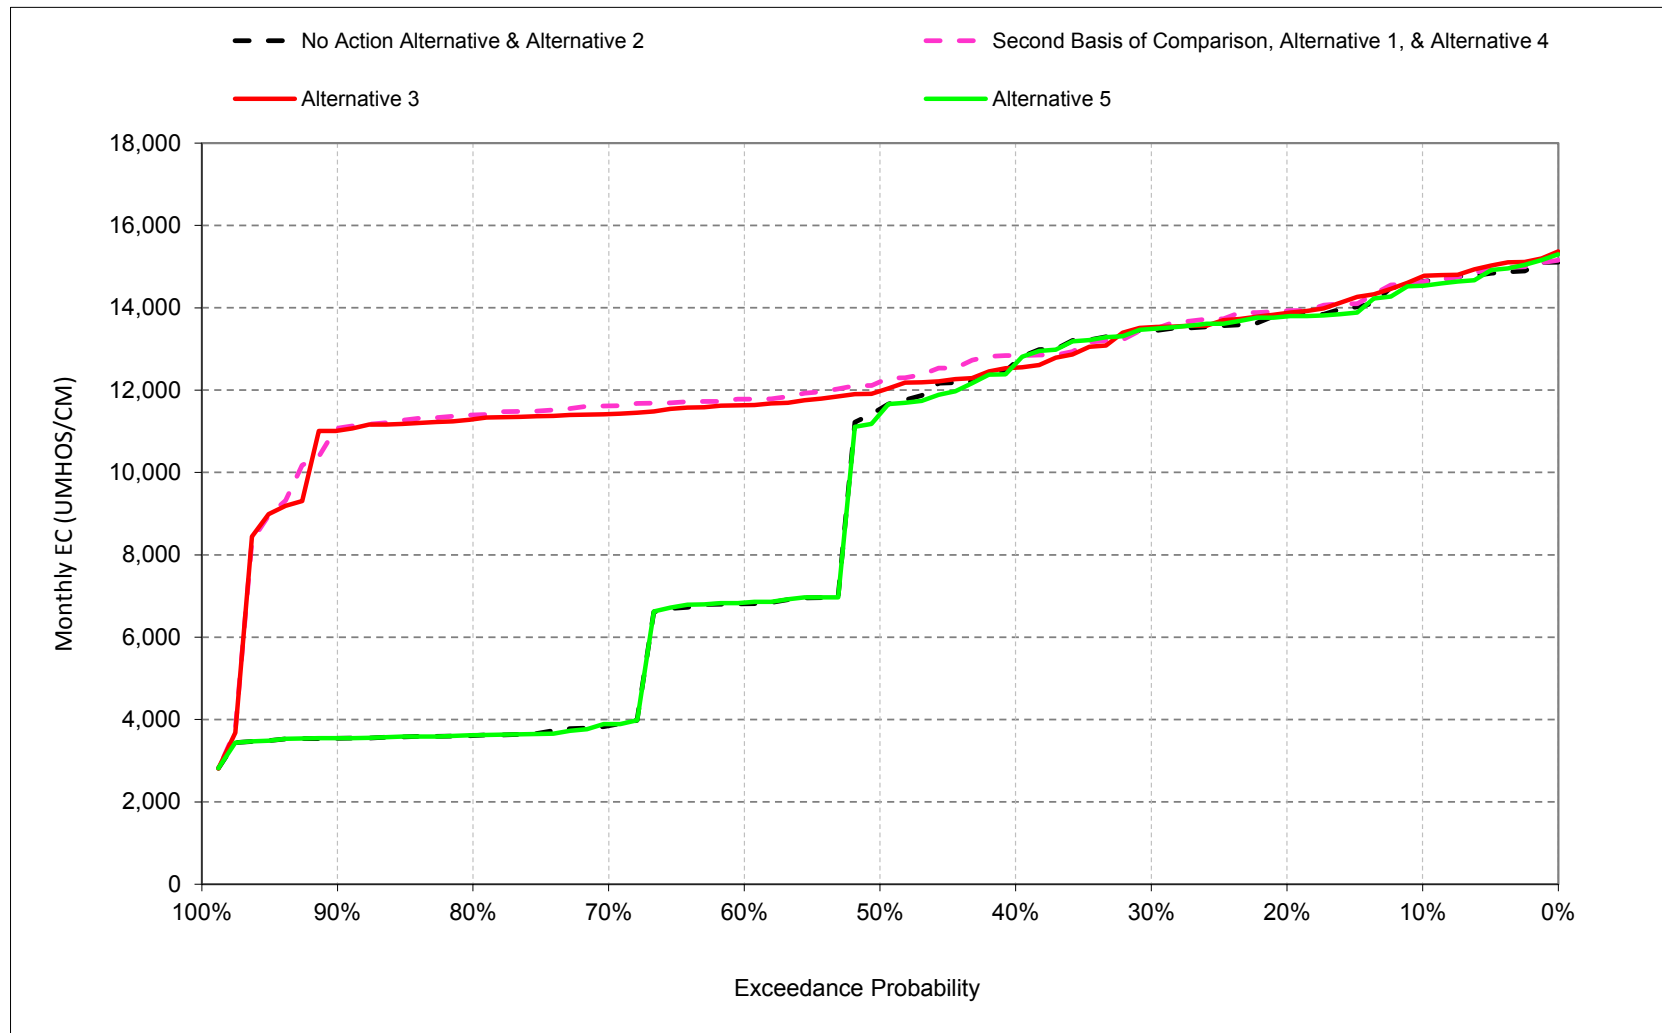

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.10.1.1. Chippis Island North Channel Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	16,091	16,410	14,299	9,461	4,594	3,874	5,056	6,466	8,102	10,866	13,118	14,635
20%	14,910	14,654	12,403	8,195	2,790	2,822	3,202	5,574	7,296	9,620	11,914	13,816
30%	14,772	14,200	8,965	6,650	1,543	1,207	2,243	4,702	6,807	8,917	11,452	13,448
40%	14,450	12,367	7,870	3,908	946	991	1,395	2,830	6,240	7,347	10,052	12,678
50%	13,338	7,076	6,955	2,892	544	529	931	2,133	5,033	6,606	9,166	11,541
60%	7,131	6,762	6,284	1,461	291	326	541	1,331	4,686	5,315	8,862	6,808
70%	3,743	3,734	2,848	396	218	220	367	938	3,585	4,973	8,504	3,923
80%	3,619	3,443	1,049	229	206	201	226	423	2,273	4,576	8,046	3,626
90%	3,476	3,273	390	196	192	192	195	204	755	3,933	7,763	3,547
Long Term												
Full Simulation Period ^b	9,942	8,989	6,959	4,015	1,732	1,360	1,818	2,921	5,139	6,966	9,887	9,289
Water Year Types^c												
Wet (32%)	7,505	6,020	2,479	856	256	293	391	718	2,367	4,039	7,978	3,597
Above Normal (16%)	11,854	9,256	6,254	1,827	537	411	586	1,368	4,321	5,149	8,193	6,812
Below Normal (13%)	7,604	7,339	7,403	4,923	2,016	1,846	2,203	3,361	5,869	6,803	9,374	12,271
Dry (24%)	10,759	10,494	9,724	6,326	2,523	1,552	2,290	3,929	6,302	9,154	11,603	13,394
Critical (15%)	13,934	14,136	12,413	8,549	4,648	3,936	5,109	7,293	9,421	11,781	13,470	14,728
Alternative 1												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	15,961	16,152	14,331	11,845	6,611	5,098	5,332	6,664	8,134	10,775	13,396	14,633
20%	14,806	14,596	14,156	10,477	3,954	3,083	3,952	5,660	7,103	9,633	12,108	13,927
30%	14,458	14,288	13,345	8,975	2,610	1,554	3,162	5,215	6,426	9,044	11,737	13,478
40%	14,255	14,041	12,641	6,162	1,291	1,300	2,276	3,751	5,531	7,277	10,469	12,838
50%	13,846	13,701	11,175	4,328	793	716	1,610	3,093	5,039	6,713	9,402	12,201
60%	13,497	13,166	8,523	2,101	389	323	963	2,145	4,558	5,729	8,914	11,781
70%	13,263	12,918	4,786	454	222	220	453	1,546	3,749	5,378	8,683	11,614
80%	12,860	11,919	2,181	256	206	203	240	555	2,650	4,714	8,429	11,397
90%	11,641	6,920	655	199	191	193	197	215	807	3,971	7,962	11,076
Long Term												
Full Simulation Period ^b	13,474	12,472	8,946	5,099	2,233	1,613	2,197	3,378	5,058	7,093	10,105	12,315
Water Year Types^c												
Wet (32%)	12,231	10,658	3,836	1,189	287	308	569	1,037	2,348	4,229	8,134	10,527
Above Normal (16%)	14,219	12,183	8,747	2,689	736	441	937	2,047	4,162	5,316	8,503	11,606
Below Normal (13%)	13,062	11,765	10,141	7,079	2,941	2,139	2,821	3,991	5,330	6,912	9,825	12,457
Dry (24%)	14,004	13,831	12,203	8,117	3,282	1,938	2,785	4,349	6,272	9,155	11,778	13,544
Critical (15%)	14,855	15,096	13,712	9,339	5,676	4,683	5,538	7,708	9,629	11,950	13,581	14,776
Alternative 1 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-130	-259	32	2,384	2,017	1,224	277	198	31	-91	279	-2
20%	-104	-59	1,753	2,282	1,164	261	750	86	-193	13	193	111
30%	-313	88	4,381	2,325	1,068	347	919	514	-381	127	285	30
40%	-196	1,674	4,771	2,254	344	309	881	921	-709	-70	417	160
50%	508	6,625	4,220	1,436	249	188	679	960	6	107	236	660
60%	6,366	6,404	2,239	641	98	-2	422	814	-128	414	53	4,973
70%	9,521	9,183	1,938	58	4	0	86	608	163	405	179	7,691
80%	9,241	8,476	1,132	27	0	2	14	132	377	138	384	7,772
90%	8,165	3,648	265	2	-1	1	1	11	52	38	198	7,529
Long Term												
Full Simulation Period ^b	3,532	3,483	1,988	1,084	501	252	379	457	-80	126	218	3,026
Water Year Types^c												
Wet (32%)	4,726	4,639	1,357	333	31	15	178	320	-19	191	156	6,930
Above Normal (16%)	2,366	2,927	2,493	861	199	30	351	678	-158	167	310	4,794
Below Normal (13%)	5,458	4,426	2,739	2,156	925	293	619	630	-539	109	451	186
Dry (24%)	3,245	3,337	2,479	1,791	759	386	495	421	-30	1	175	150
Critical (15%)	922	960	1,298	790	1,028	747	430	415	208	169	111	47

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.10.1.2. Chippis Island North Channel Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	16,091	16,410	14,299	9,461	4,594	3,874	5,056	6,466	8,102	10,866	13,118	14,635
20%	14,910	14,654	12,403	8,195	2,790	2,822	3,202	5,574	7,296	9,620	11,914	13,816
30%	14,772	14,200	8,965	6,650	1,543	1,207	2,243	4,702	6,807	8,917	11,452	13,448
40%	14,450	12,367	7,870	3,908	946	991	1,395	2,830	6,240	7,347	10,052	12,678
50%	13,338	7,076	6,955	2,892	544	529	931	2,133	5,033	6,606	9,166	11,541
60%	7,131	6,762	6,284	1,461	291	326	541	1,331	4,686	5,315	8,862	6,808
70%	3,743	3,734	2,848	396	218	220	367	938	3,585	4,973	8,504	3,923
80%	3,619	3,443	1,049	229	206	201	226	423	2,273	4,576	8,046	3,626
90%	3,476	3,273	390	196	192	192	195	204	755	3,933	7,763	3,547
Long Term												
Full Simulation Period ^b	9,942	8,989	6,959	4,015	1,732	1,360	1,818	2,921	5,139	6,966	9,887	9,289
Water Year Types ^c												
Wet (32%)	7,505	6,020	2,479	856	256	293	391	718	2,367	4,039	7,978	3,597
Above Normal (16%)	11,854	9,256	6,254	1,827	537	411	586	1,368	4,321	5,149	8,193	6,812
Below Normal (13%)	7,604	7,339	7,403	4,923	2,016	1,846	2,203	3,361	5,869	6,803	9,374	12,271
Dry (24%)	10,759	10,494	9,724	6,326	2,523	1,552	2,290	3,929	6,302	9,154	11,603	13,394
Critical (15%)	13,934	14,136	12,413	8,549	4,648	3,936	5,109	7,293	9,421	11,781	13,470	14,728

Alternative 3												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	15,908	16,423	14,317	10,601	4,830	3,905	5,008	6,802	8,094	10,711	13,243	14,758
20%	14,942	14,734	13,994	9,206	2,759	2,788	3,732	5,704	7,376	9,598	12,036	13,872
30%	14,664	14,371	13,373	8,020	1,632	1,268	2,650	5,173	6,821	9,053	11,410	13,527
40%	14,234	14,068	12,298	4,344	1,072	1,014	2,111	3,997	6,393	7,192	9,989	12,543
50%	13,771	13,812	11,095	3,088	599	605	1,535	3,331	5,529	6,657	9,044	11,979
60%	13,399	13,246	8,573	1,444	264	337	920	2,362	4,843	5,441	8,812	11,631
70%	13,207	12,984	3,639	394	218	220	507	1,554	3,989	5,043	8,407	11,417
80%	12,888	11,831	2,119	223	206	199	233	681	2,875	4,776	8,173	11,292
90%	11,906	6,565	624	197	191	193	195	218	969	4,083	7,647	11,079
Long Term												
Full Simulation Period ^b	13,533	12,580	8,776	4,415	1,757	1,365	2,070	3,425	5,364	7,025	9,924	12,227
Water Year Types ^c												
Wet (32%)	12,172	10,724	3,661	955	264	316	570	1,138	2,652	4,152	7,934	10,469
Above Normal (16%)	14,446	12,291	8,376	2,055	507	403	886	2,142	4,595	5,243	8,311	11,531
Below Normal (13%)	13,235	11,993	10,165	5,620	2,046	1,830	2,629	4,066	6,146	6,810	9,331	12,053
Dry (24%)	13,970	13,908	12,118	7,005	2,519	1,552	2,567	4,407	6,458	9,091	11,671	13,510
Critical (15%)	15,043	15,240	13,449	9,050	4,810	3,940	5,261	7,543	9,534	11,937	13,613	14,808

Alternative 3 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-184	13	18	1,139	236	31	-48	336	-8	-156	126	123
20%	32	79	1,592	1,011	-31	-34	530	129	80	-22	121	56
30%	-108	171	4,409	1,370	89	61	408	471	14	136	-42	79
40%	-216	1,701	4,428	436	126	23	716	1,167	154	-155	-64	-135
50%	433	6,736	4,140	196	55	77	604	1,198	496	51	-122	438
60%	6,268	6,484	2,290	-17	-27	12	379	1,031	157	126	-50	4,824
70%	9,465	9,249	791	-2	0	0	140	616	403	70	-97	7,494
80%	9,269	8,388	1,070	-6	0	-1	7	258	602	200	128	7,666
90%	8,430	3,293	234	1	-1	1	-1	15	214	150	-116	7,533
Long Term												
Full Simulation Period ^b	3,591	3,591	1,817	400	24	5	252	504	226	59	36	2,938
Water Year Types ^c												
Wet (32%)	4,667	4,704	1,181	99	7	23	179	420	285	114	-44	6,871
Above Normal (16%)	2,592	3,035	2,122	228	-30	-8	300	773	275	94	118	4,720
Below Normal (13%)	5,631	4,653	2,762	697	30	-16	426	705	277	6	-43	-218
Dry (24%)	3,210	3,414	2,395	679	-4	1	277	479	156	-63	67	116
Critical (15%)	1,109	1,105	1,035	501	162	4	153	250	113	156	143	80

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.10.1.3. Chippis Island North Channel Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	16,091	16,410	14,299	9,461	4,594	3,874	5,056	6,466	8,102	10,866	13,118	14,635
20%	14,910	14,654	12,403	8,195	2,790	2,822	3,202	5,574	7,296	9,620	11,914	13,816
30%	14,772	14,200	8,965	6,650	1,543	1,207	2,243	4,702	6,807	8,917	11,452	13,448
40%	14,450	12,367	7,870	3,908	946	991	1,395	2,830	6,240	7,347	10,052	12,678
50%	13,338	7,076	6,955	2,892	544	529	931	2,133	5,033	6,606	9,166	11,541
60%	7,131	6,762	6,284	1,461	291	326	541	1,331	4,686	5,315	8,862	6,808
70%	3,743	3,734	2,848	396	218	220	367	938	3,585	4,973	8,504	3,923
80%	3,619	3,443	1,049	229	206	201	226	423	2,273	4,576	8,046	3,626
90%	3,476	3,273	390	196	192	192	195	204	755	3,933	7,763	3,547
Long Term												
Full Simulation Period ^b	9,942	8,989	6,959	4,015	1,732	1,360	1,818	2,921	5,139	6,966	9,887	9,289
Water Year Types ^c												
Wet (32%)	7,505	6,020	2,479	856	256	293	391	718	2,367	4,039	7,978	3,597
Above Normal (16%)	11,854	9,256	6,254	1,827	537	411	586	1,368	4,321	5,149	8,193	6,812
Below Normal (13%)	7,604	7,339	7,403	4,923	2,016	1,846	2,203	3,361	5,869	6,803	9,374	12,271
Dry (24%)	10,759	10,494	9,724	6,326	2,523	1,552	2,290	3,929	6,302	9,154	11,603	13,394
Critical (15%)	13,934	14,136	12,413	8,549	4,648	3,936	5,109	7,293	9,421	11,781	13,470	14,728

Alternative 5												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	16,072	16,300	14,315	9,456	4,605	3,878	4,451	5,504	7,949	10,854	13,079	14,538
20%	15,007	14,656	12,224	8,219	2,795	2,823	3,004	4,902	6,943	9,430	11,983	13,788
30%	14,756	14,204	8,981	6,650	1,543	1,225	2,086	4,133	6,724	8,883	11,431	13,488
40%	14,353	12,335	7,867	3,907	946	989	1,308	2,686	5,965	7,316	10,023	12,642
50%	13,173	7,048	6,970	2,894	545	544	929	2,018	5,023	6,612	9,183	11,422
60%	7,133	6,680	6,286	1,458	290	324	549	1,378	4,653	5,331	8,836	6,841
70%	3,742	3,734	2,811	394	218	220	367	897	3,561	4,972	8,470	3,919
80%	3,622	3,444	1,057	226	206	201	227	400	2,250	4,586	7,997	3,627
90%	3,472	3,274	393	196	192	192	196	204	756	3,937	7,771	3,546
Long Term												
Full Simulation Period ^b	9,934	8,958	6,956	4,041	1,755	1,364	1,666	2,647	4,989	6,908	9,837	9,276
Water Year Types ^c												
Wet (32%)	7,503	6,041	2,482	854	256	293	387	683	2,353	3,997	7,917	3,595
Above Normal (16%)	11,839	9,063	6,185	1,825	537	411	583	1,330	4,297	5,147	8,190	6,831
Below Normal (13%)	7,615	7,345	7,409	4,930	2,014	1,845	2,019	3,071	5,776	6,777	9,327	12,200
Dry (24%)	10,748	10,473	9,753	6,359	2,533	1,556	2,012	3,503	6,110	9,107	11,564	13,388
Critical (15%)	13,904	14,115	12,412	8,670	4,791	3,960	4,708	6,511	8,860	11,576	13,371	14,700

Alternative 5 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-20	-110	16	-5	11	3	-604	-962	-154	-13	-39	-97
20%	98	2	-178	24	6	1	-198	-673	-353	-190	68	-28
30%	-15	4	16	0	0	18	-157	-569	-84	-34	-22	40
40%	-97	-31	-3	-1	0	-2	-87	-144	-274	-32	-29	-36
50%	-165	-27	15	3	1	15	-2	-115	-10	6	17	-119
60%	2	-82	2	-3	-1	-1	8	47	-33	16	-26	33
70%	-1	-1	-37	-2	0	0	0	-41	-24	-1	-34	-5
80%	4	1	8	-3	0	0	1	-23	-23	10	-49	1
90%	-4	1	3	0	0	0	0	0	1	4	7	0
Long Term												
Full Simulation Period ^b	-8	-31	-2	26	23	4	-153	-274	-150	-58	-50	-13
Water Year Types ^c												
Wet (32%)	-2	21	2	-1	0	0	-4	-34	-14	-42	-62	-2
Above Normal (16%)	-15	-193	-69	-3	0	0	-3	-39	-24	-2	-2	20
Below Normal (13%)	11	6	6	7	-2	-1	-183	-290	-94	-26	-47	-72
Dry (24%)	-11	-21	29	33	10	4	-278	-425	-192	-46	-40	-6
Critical (15%)	-29	-21	-1	121	143	24	-401	-782	-561	-205	-99	-29

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.10.1.4. Chippis Island North Channel Salinity, Monthly EC

Second Basis of Comparison		Monthly EC (UMHOS/CM)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	15,961	16,152	14,331	11,845	6,611	5,098	5,332	6,664	8,134	10,775	13,396	14,633	
20%	14,806	14,596	14,156	10,477	3,954	3,083	3,952	5,660	7,103	9,633	12,108	13,927	
30%	14,458	14,288	13,345	8,975	2,610	1,554	3,162	5,215	6,426	9,044	11,737	13,478	
40%	14,255	14,041	12,641	6,162	1,291	1,300	2,276	3,751	5,531	7,277	10,469	12,838	
50%	13,846	13,701	11,175	4,328	793	716	1,610	3,093	5,039	6,713	9,402	12,201	
60%	13,497	13,166	8,523	2,101	389	323	963	2,145	4,558	5,729	8,914	11,781	
70%	13,263	12,918	4,786	454	222	220	453	1,546	3,749	5,378	8,683	11,614	
80%	12,860	11,919	2,181	256	206	203	240	555	2,650	4,714	8,429	11,397	
90%	11,641	6,920	655	199	191	193	197	215	807	3,971	7,962	11,076	
Long Term													
Full Simulation Period ^b	13,474	12,472	8,946	5,099	2,233	1,613	2,197	3,378	5,058	7,093	10,105	12,315	
Water Year Types^c													
Wet (32%)	12,231	10,658	3,836	1,189	287	308	569	1,037	2,348	4,229	8,134	10,527	
Above Normal (16%)	14,219	12,183	8,747	2,689	736	441	937	2,047	4,162	5,316	8,503	11,606	
Below Normal (13%)	13,062	11,765	10,141	7,079	2,941	2,139	2,821	3,991	5,330	6,912	9,825	12,457	
Dry (24%)	14,004	13,831	12,203	8,117	3,282	1,938	2,785	4,349	6,272	9,155	11,778	13,544	
Critical (15%)	14,855	15,096	13,712	9,339	5,676	4,683	5,538	7,708	9,629	11,950	13,581	14,776	
No Action Alternative													
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	16,091	16,410	14,299	9,461	4,594	3,874	5,056	6,466	8,102	10,866	13,118	14,635	
20%	14,910	14,654	12,403	8,195	2,790	2,822	3,202	5,574	7,296	9,620	11,914	13,816	
30%	14,772	14,200	8,965	6,650	1,543	1,207	2,243	4,702	6,807	8,917	11,452	13,448	
40%	14,450	12,367	7,870	3,908	946	991	1,395	2,830	6,240	7,347	10,052	12,678	
50%	13,338	7,076	6,955	2,892	544	529	931	2,133	5,033	6,606	9,166	11,541	
60%	7,131	6,762	6,284	1,461	291	326	541	1,331	4,686	5,315	8,862	6,808	
70%	3,743	3,734	2,848	396	218	220	367	938	3,585	4,973	8,504	3,923	
80%	3,619	3,443	1,049	229	206	201	226	423	2,273	4,576	8,046	3,626	
90%	3,476	3,273	390	196	192	192	195	204	755	3,933	7,763	3,547	
Long Term													
Full Simulation Period ^b	9,942	8,989	6,959	4,015	1,732	1,360	1,818	2,921	5,139	6,966	9,887	9,289	
Water Year Types^c													
Wet (32%)	7,505	6,020	2,479	856	256	293	391	718	2,367	4,039	7,978	3,597	
Above Normal (16%)	11,854	9,256	6,254	1,827	537	411	586	1,368	4,321	5,149	8,193	6,812	
Below Normal (13%)	7,604	7,339	7,403	4,923	2,016	1,846	2,203	3,361	5,869	6,803	9,374	12,271	
Dry (24%)	10,759	10,494	9,724	6,326	2,523	1,552	2,290	3,929	6,302	9,154	11,603	13,394	
Critical (15%)	13,934	14,136	12,413	8,549	4,648	3,936	5,109	7,293	9,421	11,781	13,470	14,728	
No Action Alternative minus Second Basis of Comparison													
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	130	259	-32	-2,384	-2,017	-1,224	-277	-198	-31	91	-279	2	
20%	104	59	-1,753	-2,282	-1,164	-261	-750	-86	193	-13	-193	-111	
30%	313	-88	-4,381	-2,325	-1,068	-347	-919	-514	381	-127	-285	-308	
40%	196	-1,674	-4,771	-2,254	-344	-309	-881	-921	709	70	-417	-160	
50%	-508	-6,625	-4,220	-1,436	-249	-188	-679	-960	-6	-107	-236	-660	
60%	-6,366	-6,404	-2,239	-641	-98	2	-422	-814	128	-414	-53	-4,973	
70%	-9,521	-9,183	-1,938	-58	-4	0	-86	-608	-163	-405	-179	-7,691	
80%	-9,241	-8,476	-1,132	-27	0	-2	-14	-132	-377	-138	-384	-7,772	
90%	-8,165	-3,648	-265	-2	1	-1	-1	-11	-52	-38	-198	-7,529	
Long Term													
Full Simulation Period ^b	-3,532	-3,483	-1,988	-1,084	-501	-252	-379	-457	80	-126	-218	-3,026	
Water Year Types^c													
Wet (32%)	-4,726	-4,639	-1,357	-333	-31	-15	-178	-320	19	-191	-156	-6,930	
Above Normal (16%)	-2,366	-2,927	-2,493	-861	-199	-30	-351	-678	158	-167	-310	-4,794	
Below Normal (13%)	-5,458	-4,426	-2,739	-2,156	-925	-293	-619	-630	539	-109	-451	-186	
Dry (24%)	-3,245	-3,337	-2,479	-1,791	-759	-386	-495	-421	30	-1	-175	-150	
Critical (15%)	-922	-960	-1,298	-790	-1,028	-747	-430	-415	-208	-169	-111	-47	

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.10.1.5. Chippis Island North Channel Salinity, Monthly EC

Second Basis of Comparison												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	15,961	16,152	14,331	11,845	6,611	5,098	5,332	6,664	8,134	10,775	13,396	14,633
20%	14,806	14,596	14,156	10,477	3,954	3,083	3,952	5,660	7,103	9,633	12,108	13,927
30%	14,458	14,288	13,345	8,975	2,610	1,554	3,162	5,215	6,426	9,044	11,737	13,478
40%	14,255	14,041	12,641	6,162	1,291	1,300	2,276	3,751	5,531	7,277	10,469	12,838
50%	13,846	13,701	11,175	4,328	793	716	1,610	3,093	5,039	6,713	9,402	12,201
60%	13,497	13,166	8,523	2,101	389	323	963	2,145	4,558	5,729	8,914	11,781
70%	13,263	12,918	4,786	454	222	220	453	1,546	3,749	5,378	8,683	11,614
80%	12,860	11,919	2,181	256	206	203	240	555	2,650	4,714	8,429	11,397
90%	11,641	6,920	655	199	191	193	197	215	807	3,971	7,962	11,076
Long Term												
Full Simulation Period ^b	13,474	12,472	8,946	5,099	2,233	1,613	2,197	3,378	5,058	7,093	10,105	12,315
Water Year Types^c												
Wet (32%)	12,231	10,658	3,836	1,189	287	308	569	1,037	2,348	4,229	8,134	10,527
Above Normal (16%)	14,219	12,183	8,747	2,689	736	441	937	2,047	4,162	5,316	8,503	11,606
Below Normal (13%)	13,062	11,765	10,141	7,079	2,941	2,139	2,821	3,991	5,330	6,912	9,825	12,457
Dry (24%)	14,004	13,831	12,203	8,117	3,282	1,938	2,785	4,349	6,272	9,155	11,778	13,544
Critical (15%)	14,855	15,096	13,712	9,339	5,676	4,683	5,538	7,708	9,629	11,950	13,581	14,776

Alternative 3

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	15,908	16,423	14,317	10,601	4,830	3,905	5,008	6,802	8,094	10,711	13,243	14,758
20%	14,942	14,734	13,994	9,206	2,759	2,788	3,732	5,704	7,376	9,598	12,036	13,872
30%	14,664	14,371	13,373	8,020	1,632	1,268	2,650	5,173	6,821	9,053	11,410	13,527
40%	14,234	14,068	12,298	4,344	1,072	1,014	2,111	3,997	6,393	7,192	9,989	12,543
50%	13,771	13,812	11,095	3,088	599	605	1,535	3,331	5,529	6,657	9,044	11,979
60%	13,399	13,246	8,573	1,444	264	337	920	2,362	4,843	5,441	8,812	11,631
70%	13,207	12,984	3,639	394	218	220	507	1,554	3,989	5,043	8,407	11,417
80%	12,888	11,831	2,119	223	206	199	233	681	2,875	4,776	8,173	11,292
90%	11,906	6,565	624	197	191	193	195	218	969	4,083	7,647	11,079
Long Term												
Full Simulation Period ^b	13,533	12,580	8,776	4,415	1,757	1,365	2,070	3,425	5,364	7,025	9,924	12,227
Water Year Types^c												
Wet (32%)	12,172	10,724	3,661	955	264	316	570	1,138	2,652	4,152	7,934	10,469
Above Normal (16%)	14,446	12,291	8,376	2,055	507	403	886	2,142	4,595	5,243	8,311	11,531
Below Normal (13%)	13,235	11,993	10,165	5,620	2,046	1,830	2,629	4,066	6,146	6,810	9,331	12,053
Dry (24%)	13,970	13,908	12,118	7,005	2,519	1,552	2,567	4,407	6,458	9,091	11,671	13,510
Critical (15%)	15,043	15,240	13,449	9,050	4,810	3,940	5,261	7,543	9,534	11,937	13,613	14,808

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-54	272	-14	-1,245	-1,781	-1,193	-324	138	-40	-64	-153	125
20%	136	138	-162	-1,271	-1,195	-295	-220	44	274	-35	-72	-56
30%	205	83	28	-954	-978	-286	-511	-42	395	8	-327	49
40%	-21	26	-343	-1,818	-219	-286	-165	246	863	-85	-481	-295
50%	-75	112	-80	-1,240	-194	-111	-75	238	490	-56	-358	-222
60%	-98	80	51	-657	-125	14	-43	217	285	-288	-102	-149
70%	-56	66	-1,147	-60	-4	0	54	9	240	-335	-276	-197
80%	28	-88	-62	-33	1	-3	-7	126	225	63	-256	-106
90%	265	-355	-31	-1	0	-1	-2	3	162	112	-315	4
Long Term												
Full Simulation Period ^b	59	108	-170	-684	-477	-248	-127	47	306	-67	-182	-88
Water Year Types^c												
Wet (32%)	-60	65	-175	-234	-23	8	1	101	304	-77	-200	-58
Above Normal (16%)	226	107	-371	-634	-229	-38	-51	95	433	-73	-192	-74
Below Normal (13%)	173	228	23	-1,459	-895	-309	-192	75	816	-103	-494	-404
Dry (24%)	-34	77	-85	-1,112	-763	-385	-218	58	186	-64	-108	-34
Critical (15%)	187	145	-263	-289	-866	-743	-277	-166	-95	-13	32	32

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.10.1.6. Chippis Island North Channel Salinity, Monthly EC

Second Basis of Comparison		Monthly EC (UMHOS/CM)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
10%	15,961	16,152	14,331	11,845	6,611	5,098	5,332	6,664	8,134	10,775	13,396	14,633	
20%	14,806	14,596	14,156	10,477	3,954	3,083	3,952	5,660	7,103	9,633	12,108	13,927	
30%	14,458	14,288	13,345	8,975	2,610	1,554	3,162	5,215	6,426	9,044	11,737	13,478	
40%	14,255	14,041	12,641	6,162	1,291	1,300	2,276	3,751	5,531	7,277	10,469	12,838	
50%	13,846	13,701	11,175	4,328	793	716	1,610	3,093	5,039	6,713	9,402	12,201	
60%	13,497	13,166	8,523	2,101	389	323	963	2,145	4,558	5,729	8,914	11,781	
70%	13,263	12,918	4,786	454	222	220	453	1,546	3,749	5,378	8,683	11,614	
80%	12,860	11,919	2,181	256	206	203	240	555	2,650	4,714	8,429	11,397	
90%	11,641	6,920	655	199	191	193	197	215	807	3,971	7,962	11,076	
Long Term													
Full Simulation Period ^b	13,474	12,472	8,946	5,099	2,233	1,613	2,197	3,378	5,058	7,093	10,105	12,315	
Water Year Types ^c													
Wet (32%)	12,231	10,658	3,836	1,189	287	308	569	1,037	2,348	4,229	8,134	10,527	
Above Normal (16%)	14,219	12,183	8,747	2,689	736	441	937	2,047	4,162	5,316	8,503	11,606	
Below Normal (13%)	13,062	11,765	10,141	7,079	2,941	2,139	2,821	3,991	5,330	6,912	9,825	12,457	
Dry (24%)	14,004	13,831	12,203	8,117	3,282	1,938	2,785	4,349	6,272	9,155	11,778	13,544	
Critical (15%)	14,855	15,096	13,712	9,339	5,676	4,683	5,538	7,708	9,629	11,950	13,581	14,776	

Alternative 5

Alternative 5		Monthly EC (UMHOS/CM)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
10%	16,072	16,300	14,315	9,456	4,605	3,878	4,451	5,504	7,949	10,854	13,079	14,538	
20%	15,007	14,656	12,224	8,219	2,795	2,823	3,004	4,902	6,943	9,430	11,983	13,788	
30%	14,756	14,204	8,981	6,650	1,543	1,225	2,086	4,133	6,724	8,883	11,431	13,488	
40%	14,353	12,335	7,867	3,907	946	989	1,308	2,686	5,965	7,316	10,023	12,642	
50%	13,173	7,048	6,970	2,894	545	544	929	2,018	5,023	6,612	9,183	11,422	
60%	7,133	6,680	6,286	1,458	290	324	549	1,378	4,653	5,331	8,836	6,841	
70%	3,742	3,734	2,811	394	218	220	367	897	3,561	4,972	8,470	3,919	
80%	3,622	3,444	1,057	226	206	201	227	400	2,250	4,586	7,997	3,627	
90%	3,472	3,274	393	196	192	192	196	204	756	3,937	7,771	3,546	
Long Term													
Full Simulation Period ^b	9,934	8,958	6,956	4,041	1,755	1,364	1,666	2,647	4,989	6,908	9,837	9,276	
Water Year Types ^c													
Wet (32%)	7,503	6,041	2,482	854	256	293	387	683	2,353	3,997	7,917	3,595	
Above Normal (16%)	11,839	9,063	6,185	1,825	537	411	583	1,330	4,297	5,147	8,190	6,831	
Below Normal (13%)	7,615	7,345	7,409	4,930	2,014	1,845	2,019	3,071	5,776	6,777	9,327	12,200	
Dry (24%)	10,748	10,473	9,753	6,359	2,533	1,556	2,012	3,503	6,110	9,107	11,564	13,388	
Critical (15%)	13,904	14,115	12,412	8,670	4,791	3,960	4,708	6,511	8,860	11,576	13,371	14,700	

Alternative 5 minus Second Basis of Comparison

Alternative 5 minus Second Basis of Comparison		Monthly EC (UMHOS/CM)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
10%	110	149	-16	-2,389	-2,006	-1,221	-881	-1,159	-185	79	-317	-96	
20%	202	60	-1,932	-2,258	-1,158	-260	-948	-759	-160	-203	-125	-139	
30%	298	-84	-4,364	-2,324	-1,068	-329	-1,076	-1,082	297	-161	-306	10	
40%	98	-1,706	-4,774	-2,255	-344	-311	-968	-1,065	435	38	-446	-196	
50%	-673	-6,652	-4,206	-1,434	-248	-173	-681	-1,075	-16	-101	-219	-779	
60%	-6,364	-6,486	-2,237	-644	-99	1	-415	-766	95	-398	-79	-4,940	
70%	-9,522	-9,184	-1,975	-60	-4	0	-86	-649	-187	-406	-214	-7,696	
80%	-9,237	-8,475	-1,124	-30	1	-2	-13	-155	-401	-127	-432	-7,770	
90%	-8,168	-3,647	-262	-2	1	-1	-1	-11	-51	-34	-191	-7,529	
Long Term													
Full Simulation Period ^b	-3,541	-3,514	-1,990	-1,058	-478	-248	-532	-731	-70	-185	-268	-3,039	
Water Year Types ^c													
Wet (32%)	-4,728	-4,618	-1,354	-334	-31	-15	-182	-354	5	-233	-217	-6,932	
Above Normal (16%)	-2,381	-3,120	-2,562	-864	-199	-30	-354	-717	134	-169	-313	-4,775	
Below Normal (13%)	-5,447	-4,420	-2,733	-2,149	-927	-294	-802	-921	446	-135	-498	-258	
Dry (24%)	-3,256	-3,358	-2,450	-1,758	-749	-382	-774	-846	-162	-47	-215	-156	
Critical (15%)	-951	-981	-1,299	-670	-885	-724	-830	-1,197	-769	-374	-210	-76	

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 **B.10.2 Chipps Island South Channel Salinity**

Figure 6E.B.10.2.1. Chipps Island South Channel Salinity, Electrical Conductivity, October

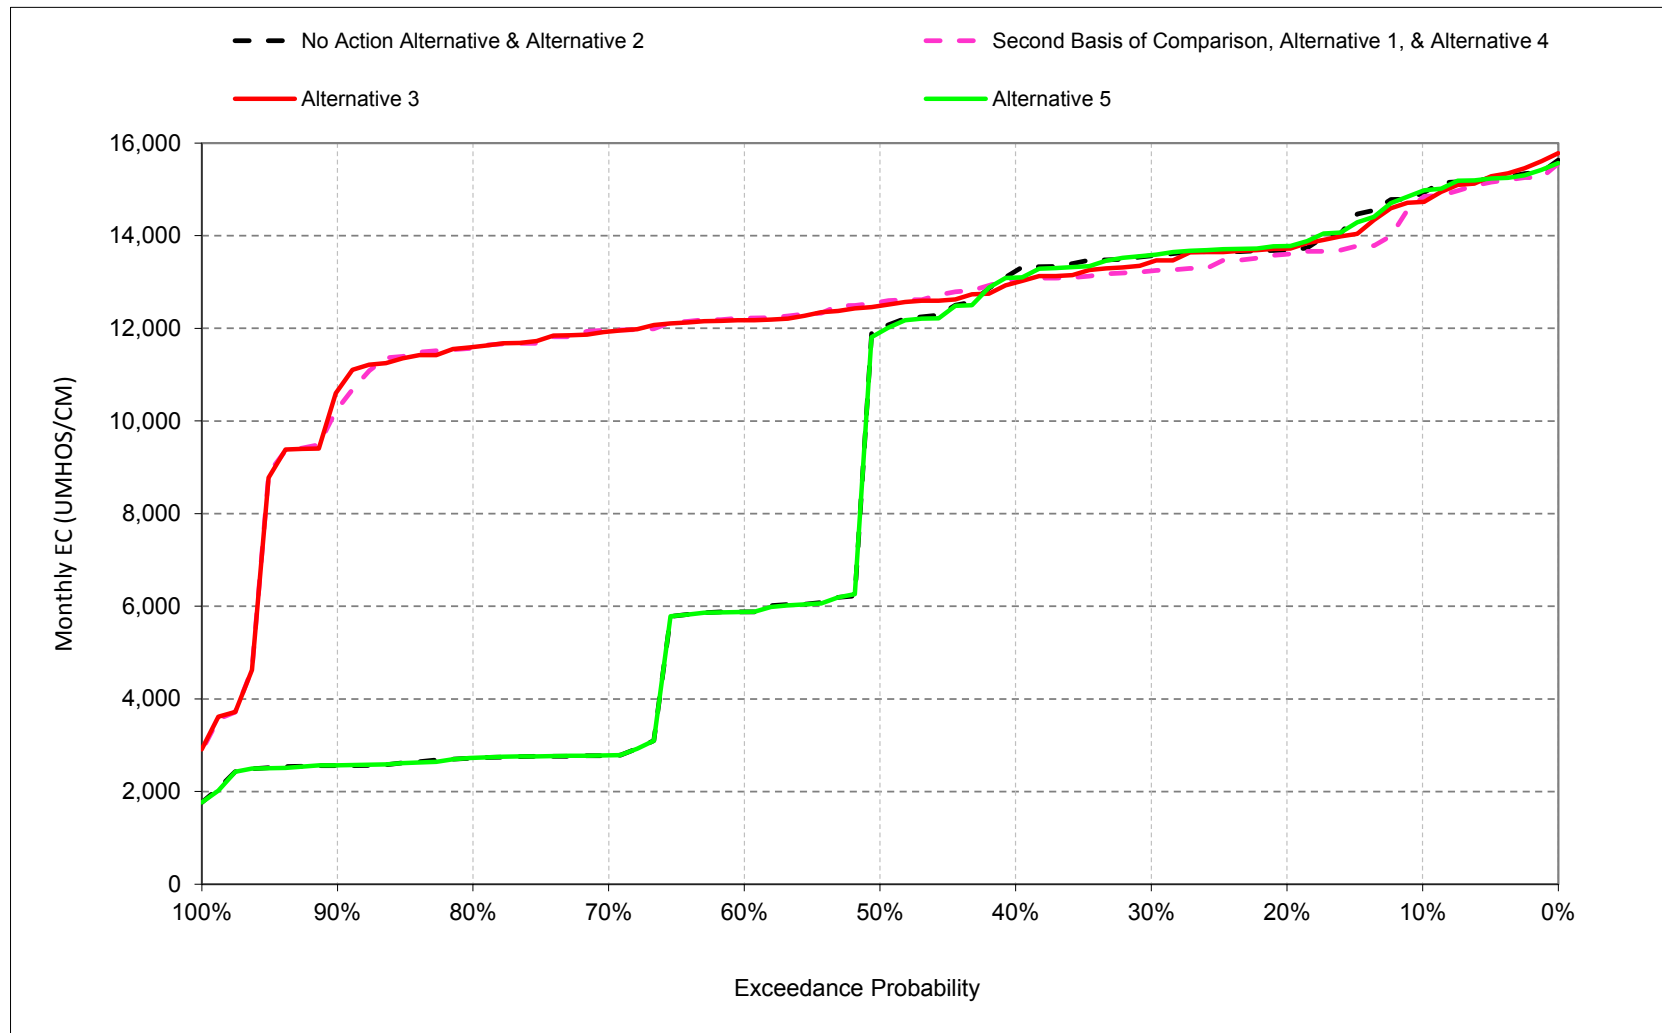


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.10.2.2. Chipps Island South Channel Salinity, Electrical Conductivity, November

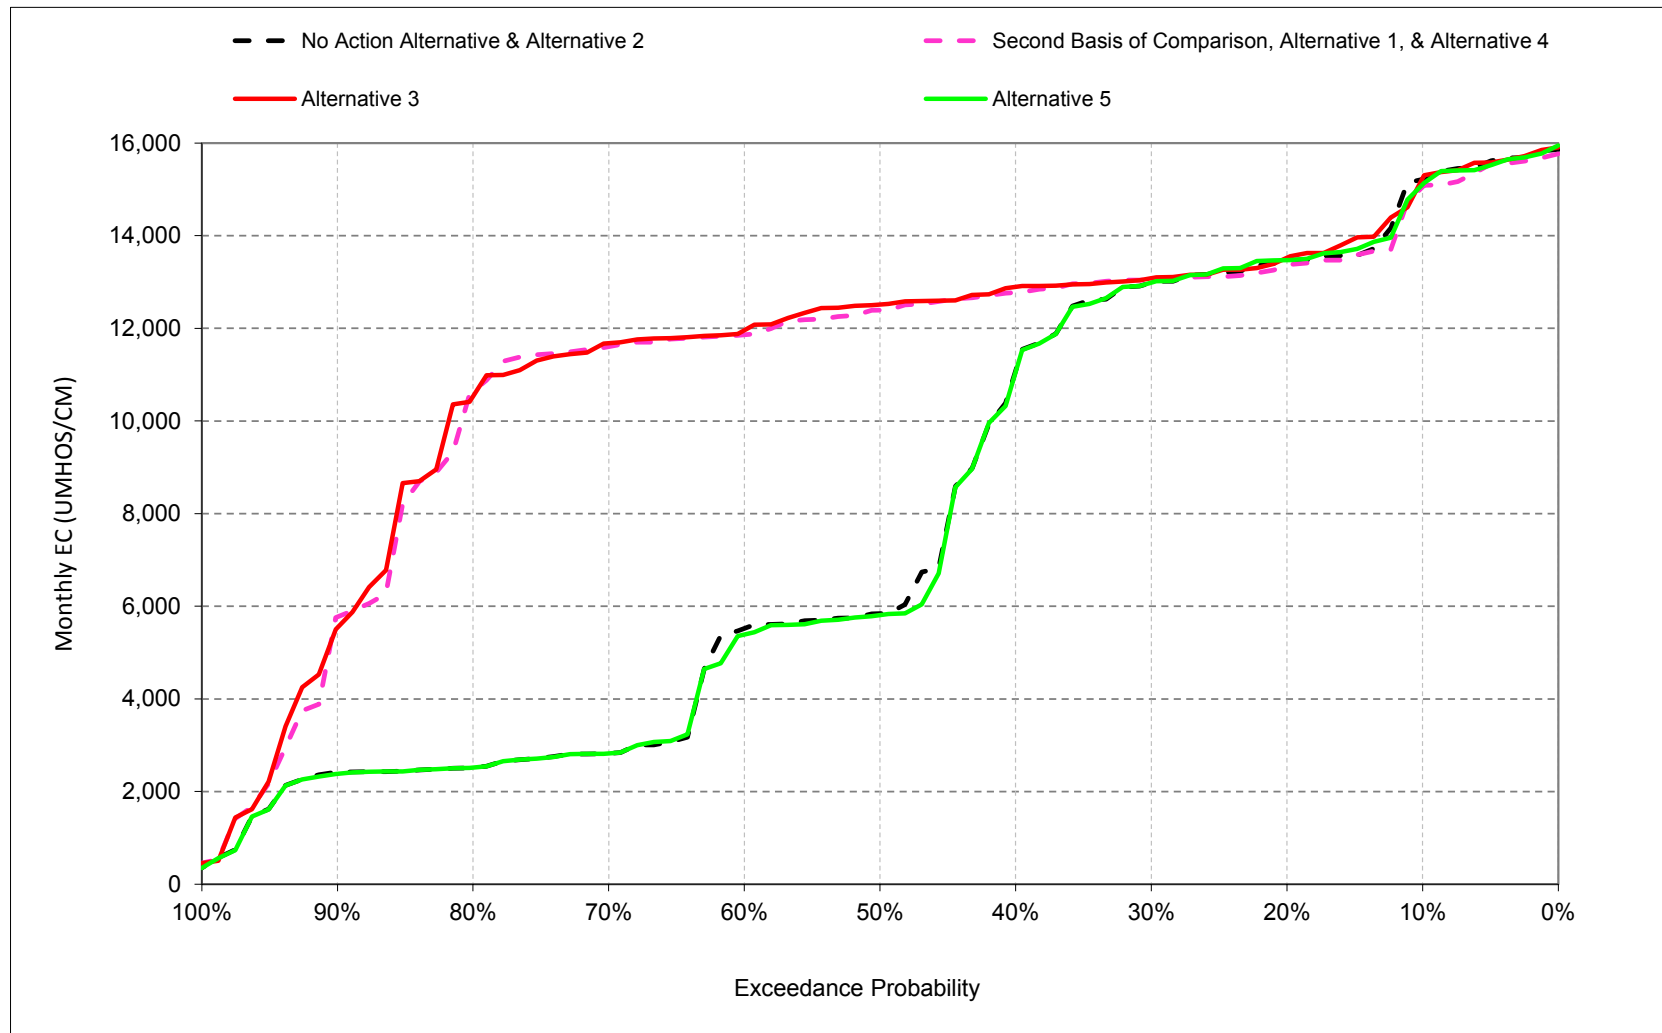


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.10.2.3. Chipps Island South Channel Salinity, Electrical Conductivity, December

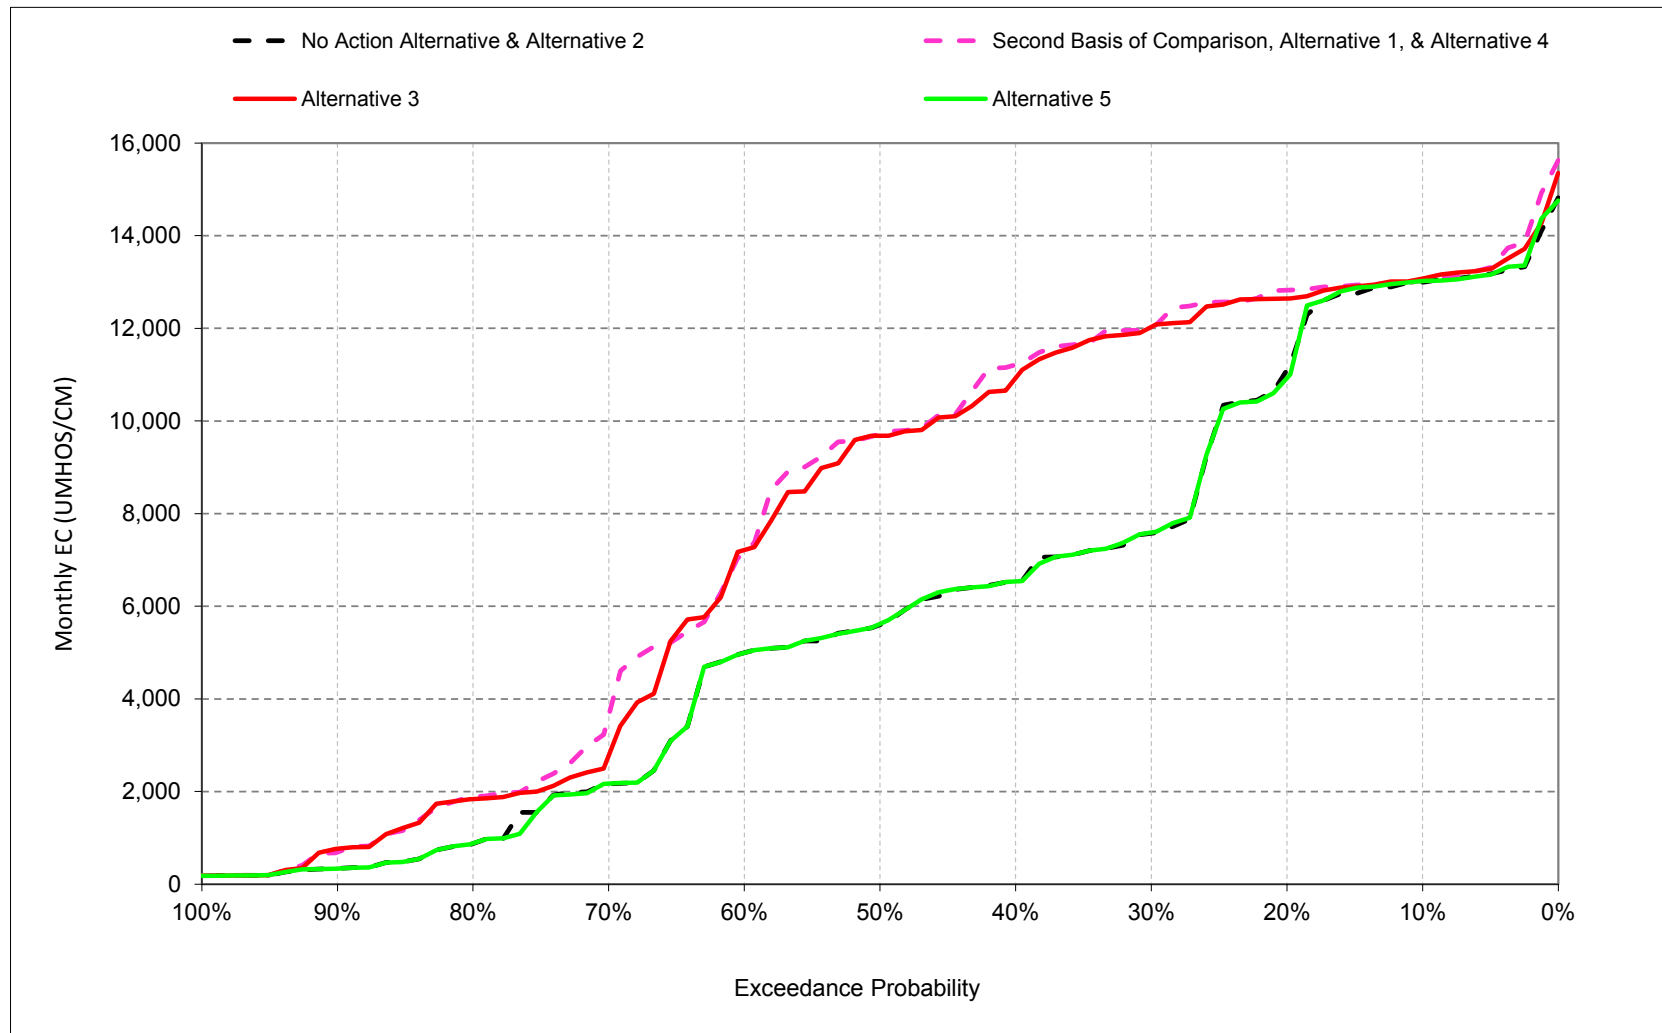


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.10.2.4. Chipps Island South Channel Salinity, Electrical Conductivity, January

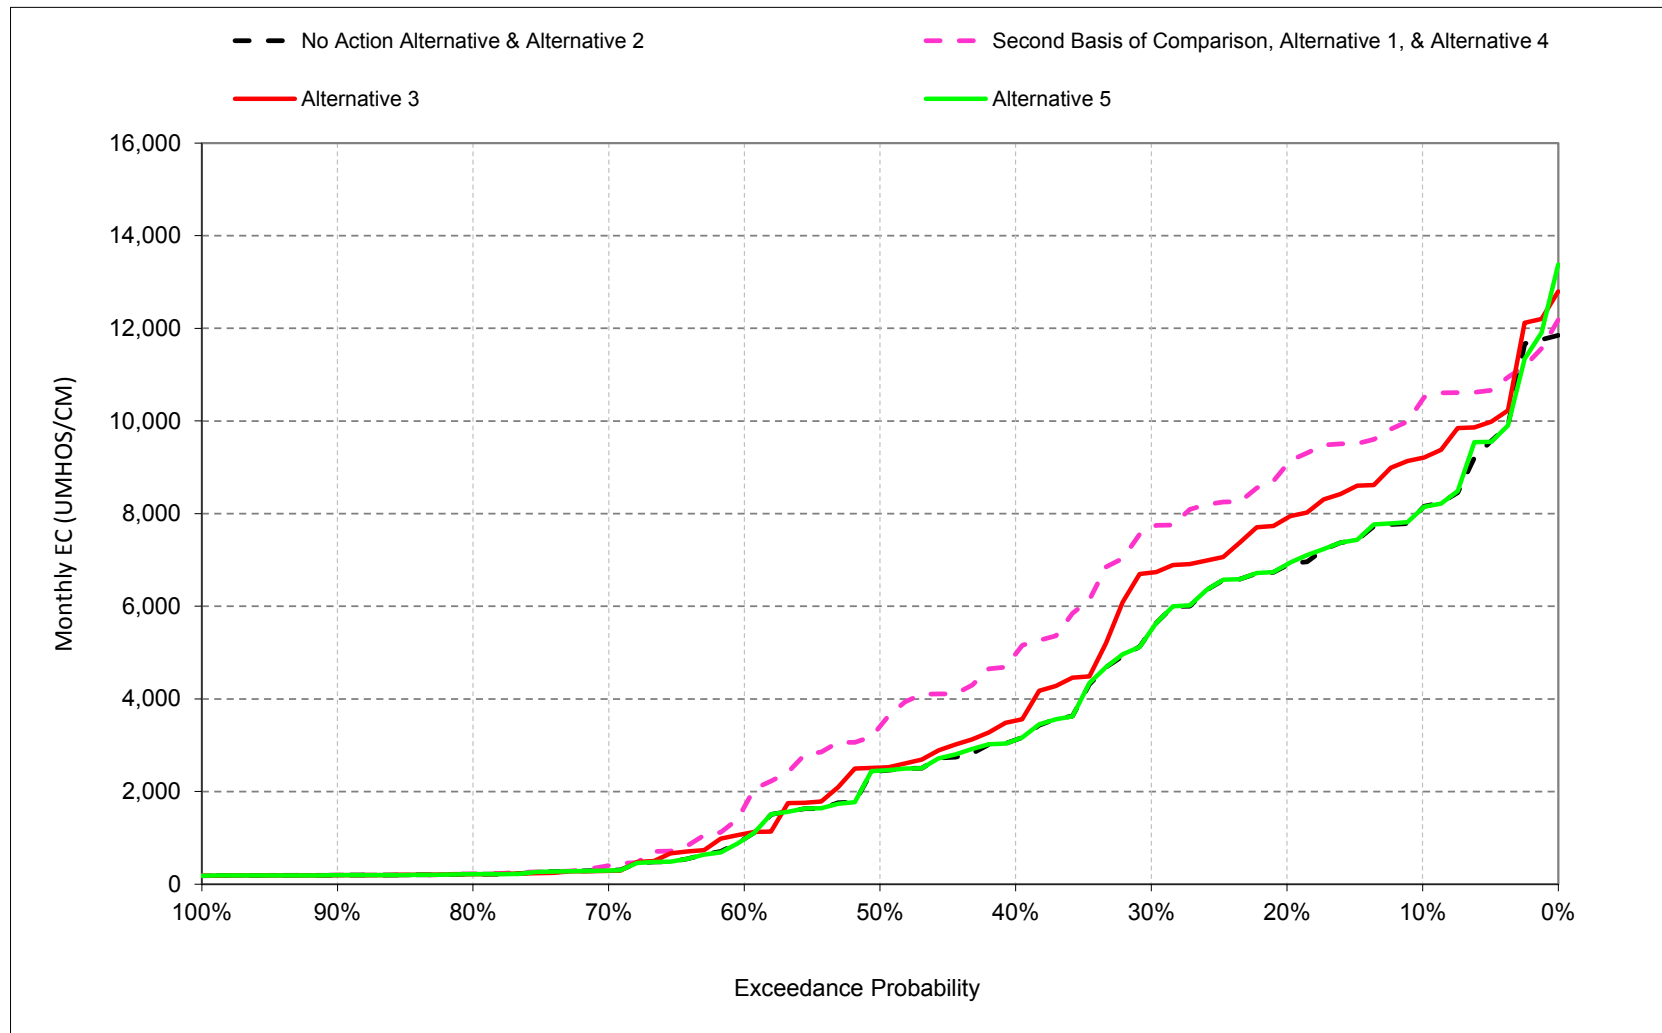


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.10.2.5. Chipps Island South Channel Salinity, Electrical Conductivity, February

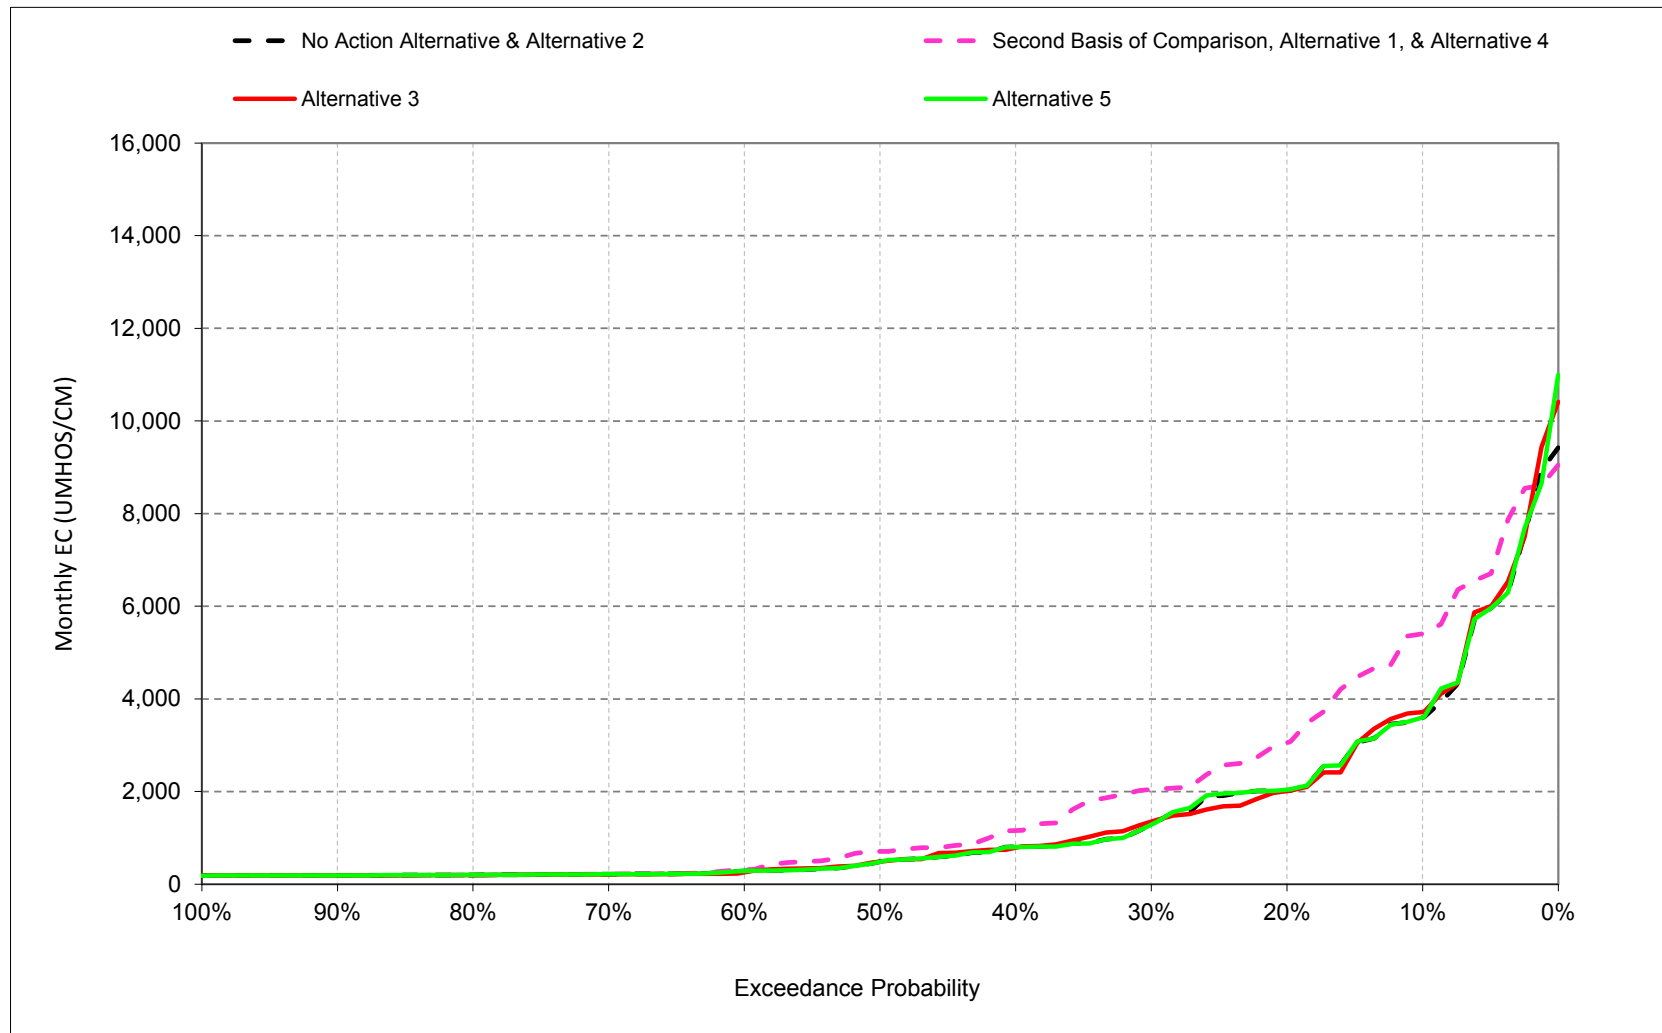


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.10.2.6. Chipps Island South Channel Salinity, Electrical Conductivity, March

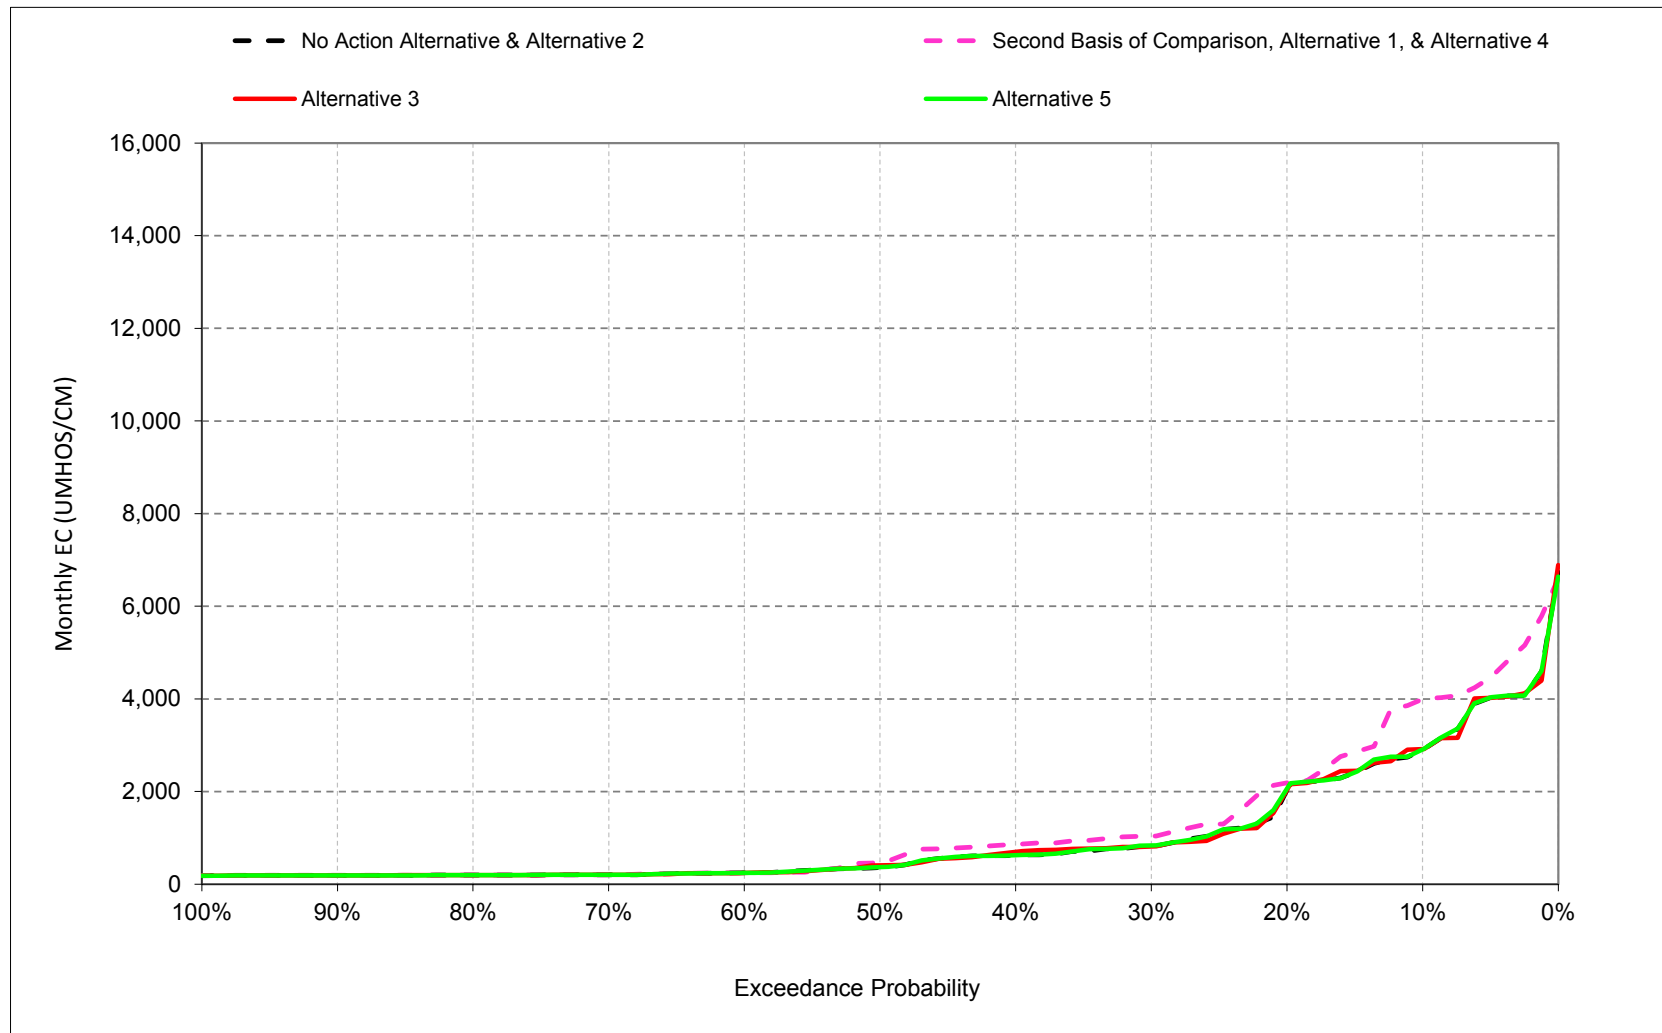


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.10.2.7. Chipps Island South Channel Salinity, Electrical Conductivity, April

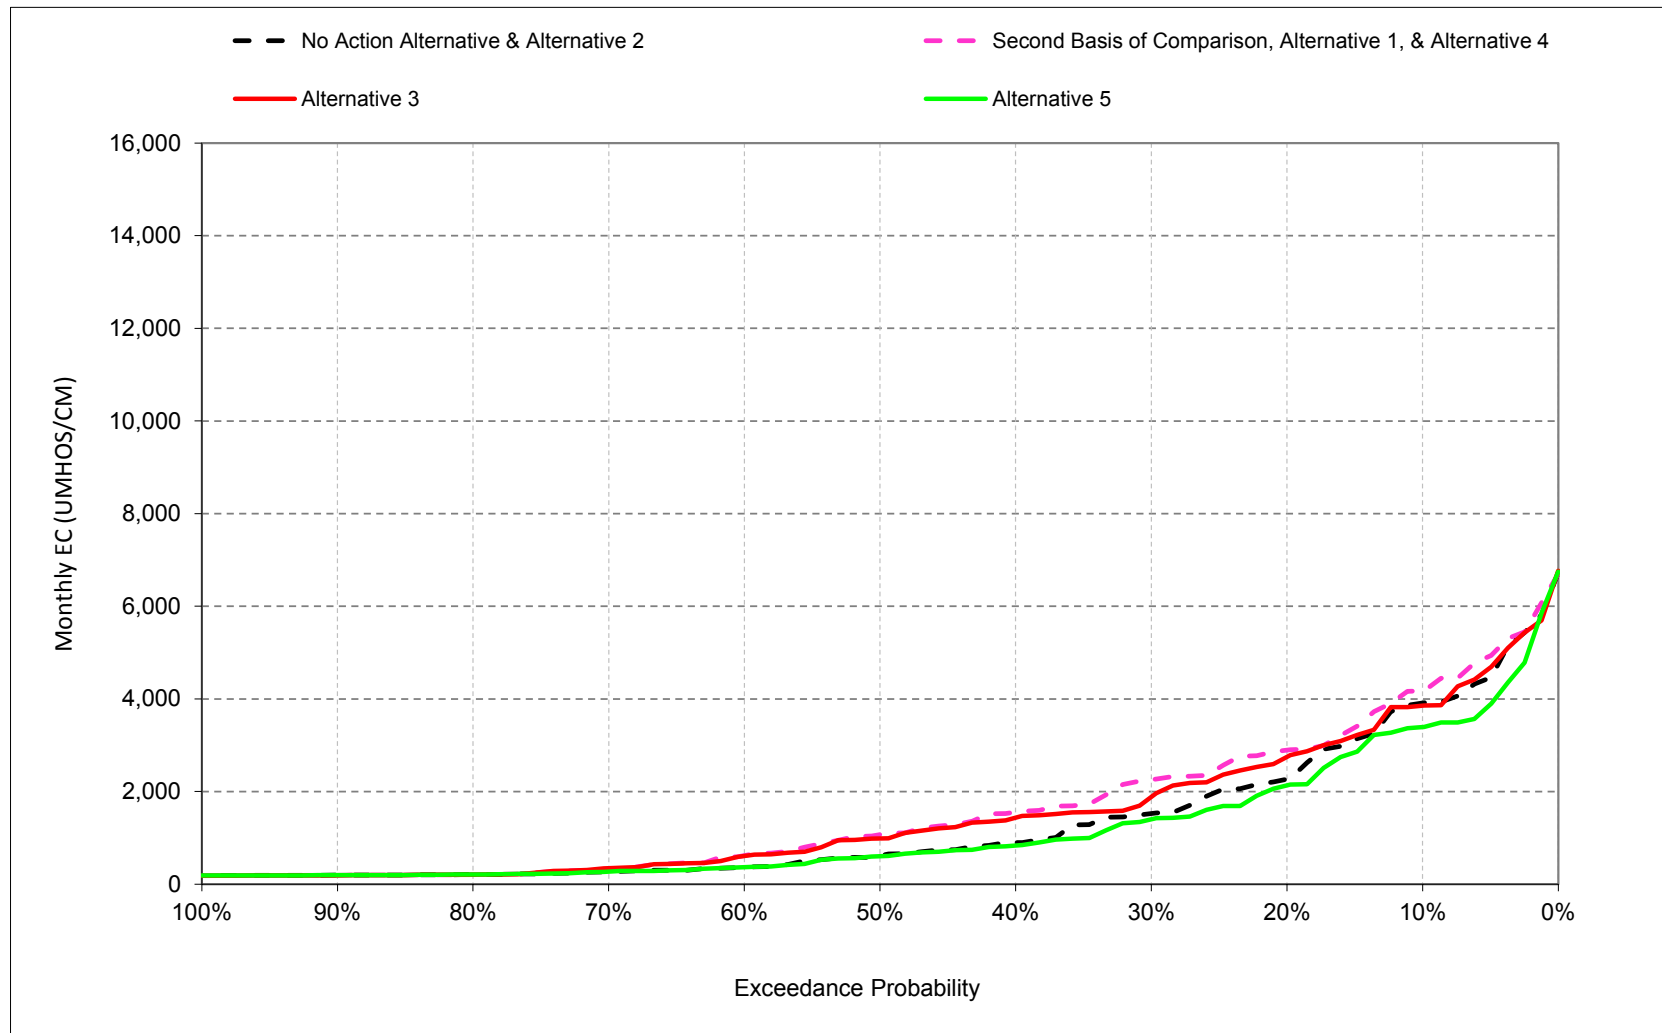


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.10.2.8. Chipps Island South Channel Salinity, Electrical Conductivity, May

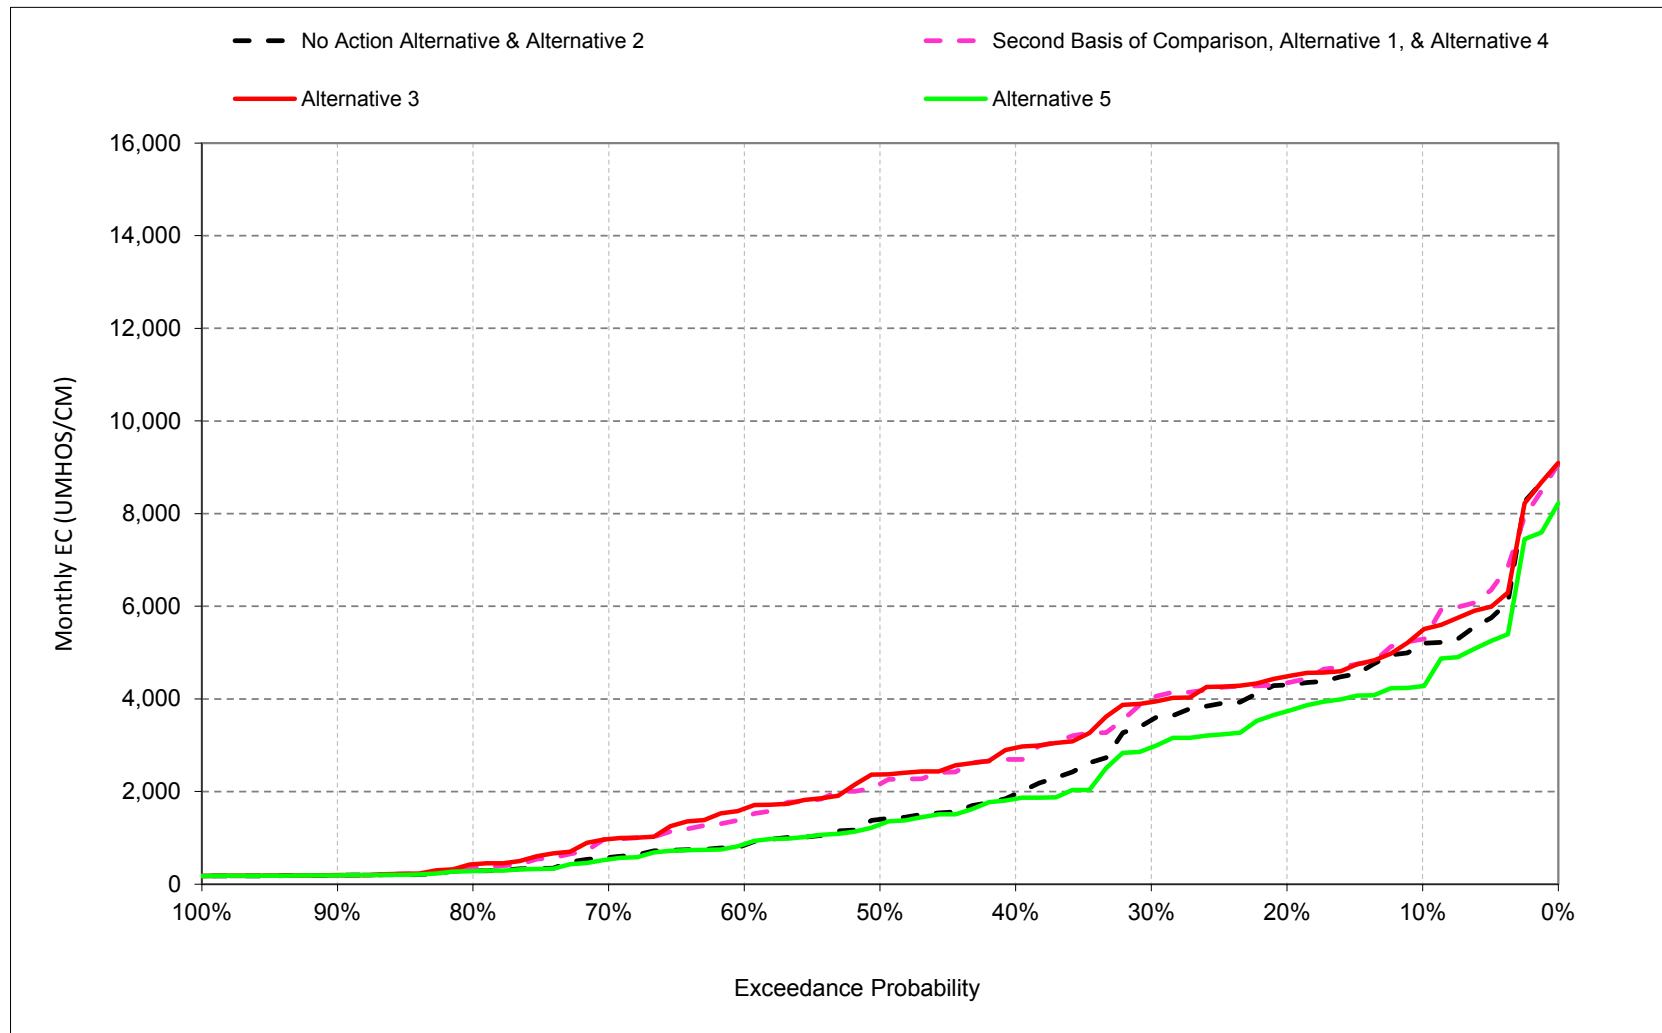


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.10.2.9. Chipps Island South Channel Salinity, Electrical Conductivity, June

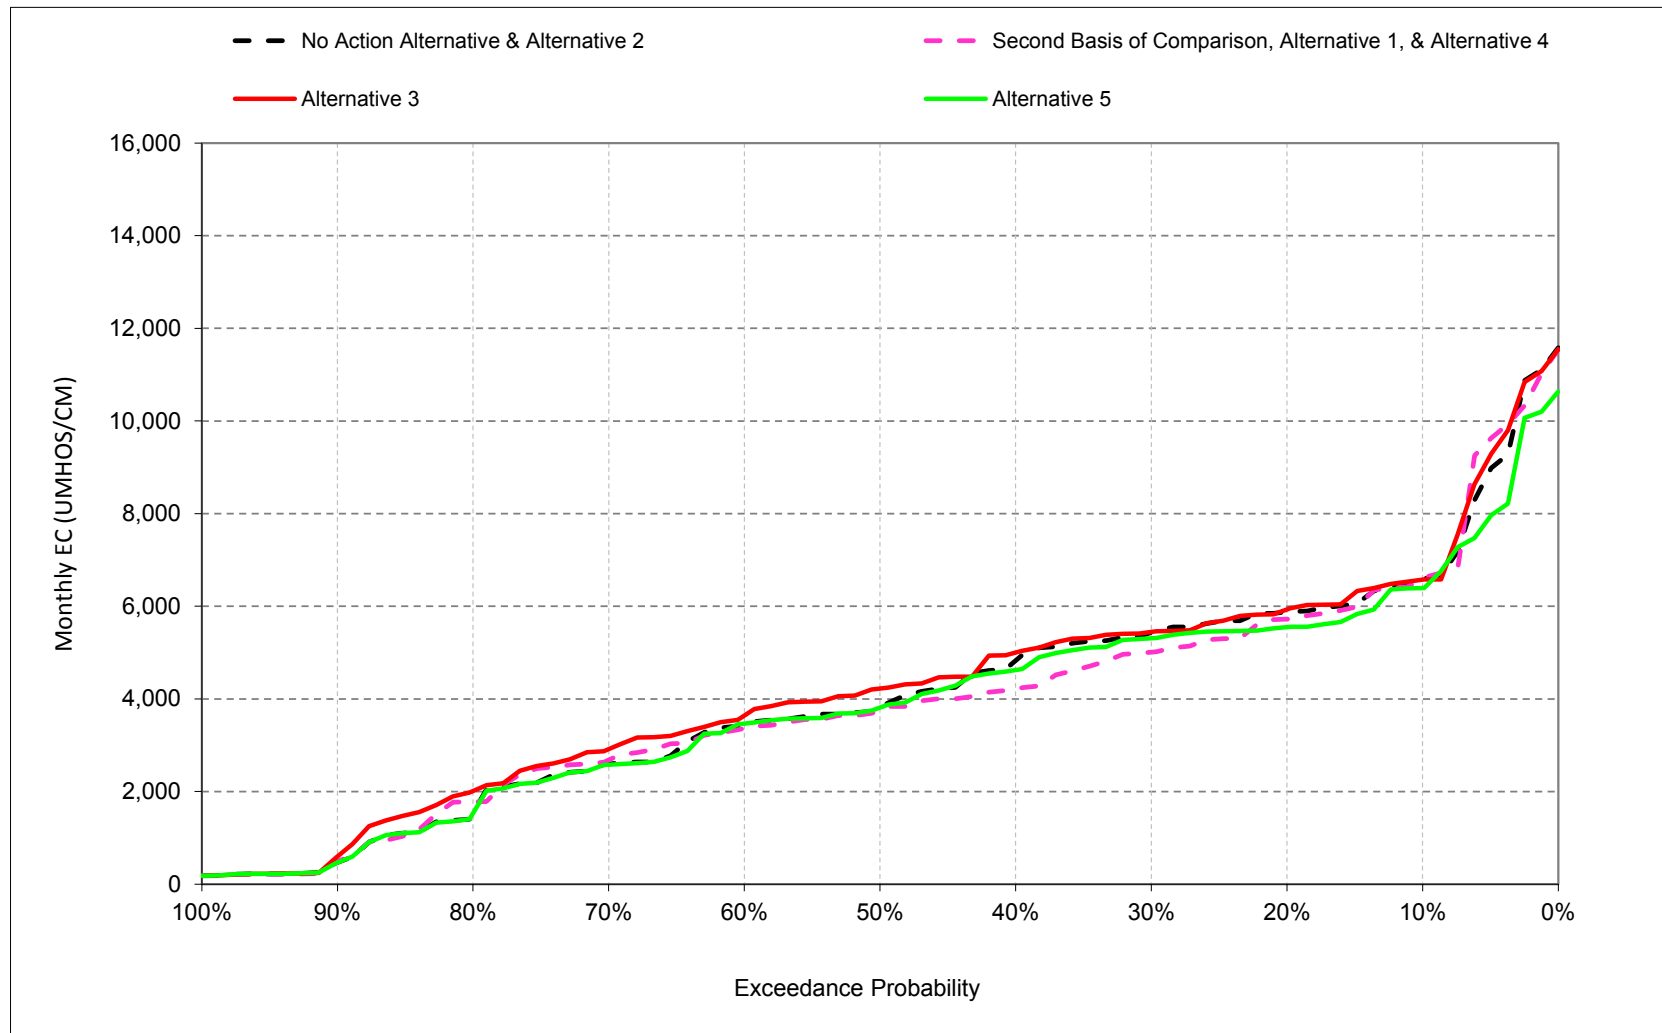


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.10.2.10. Chipps Island South Channel Salinity, Electrical Conductivity, July

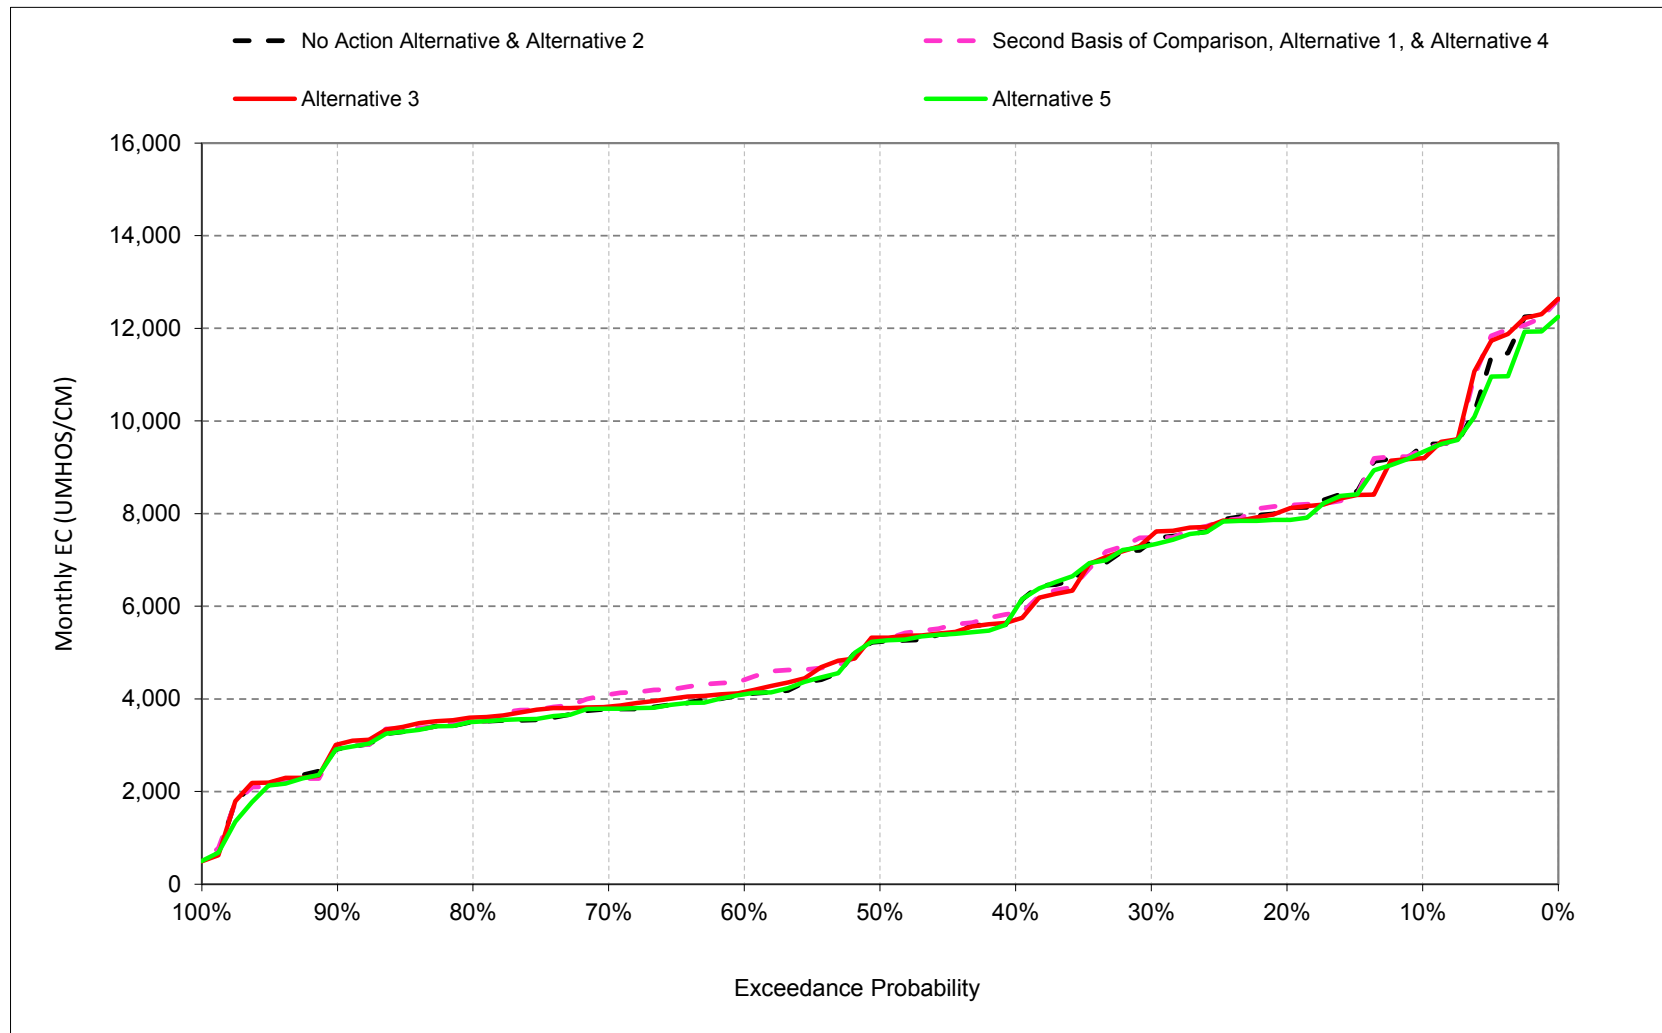


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.10.2.11. Chipps Island South Channel Salinity, Electrical Conductivity, August

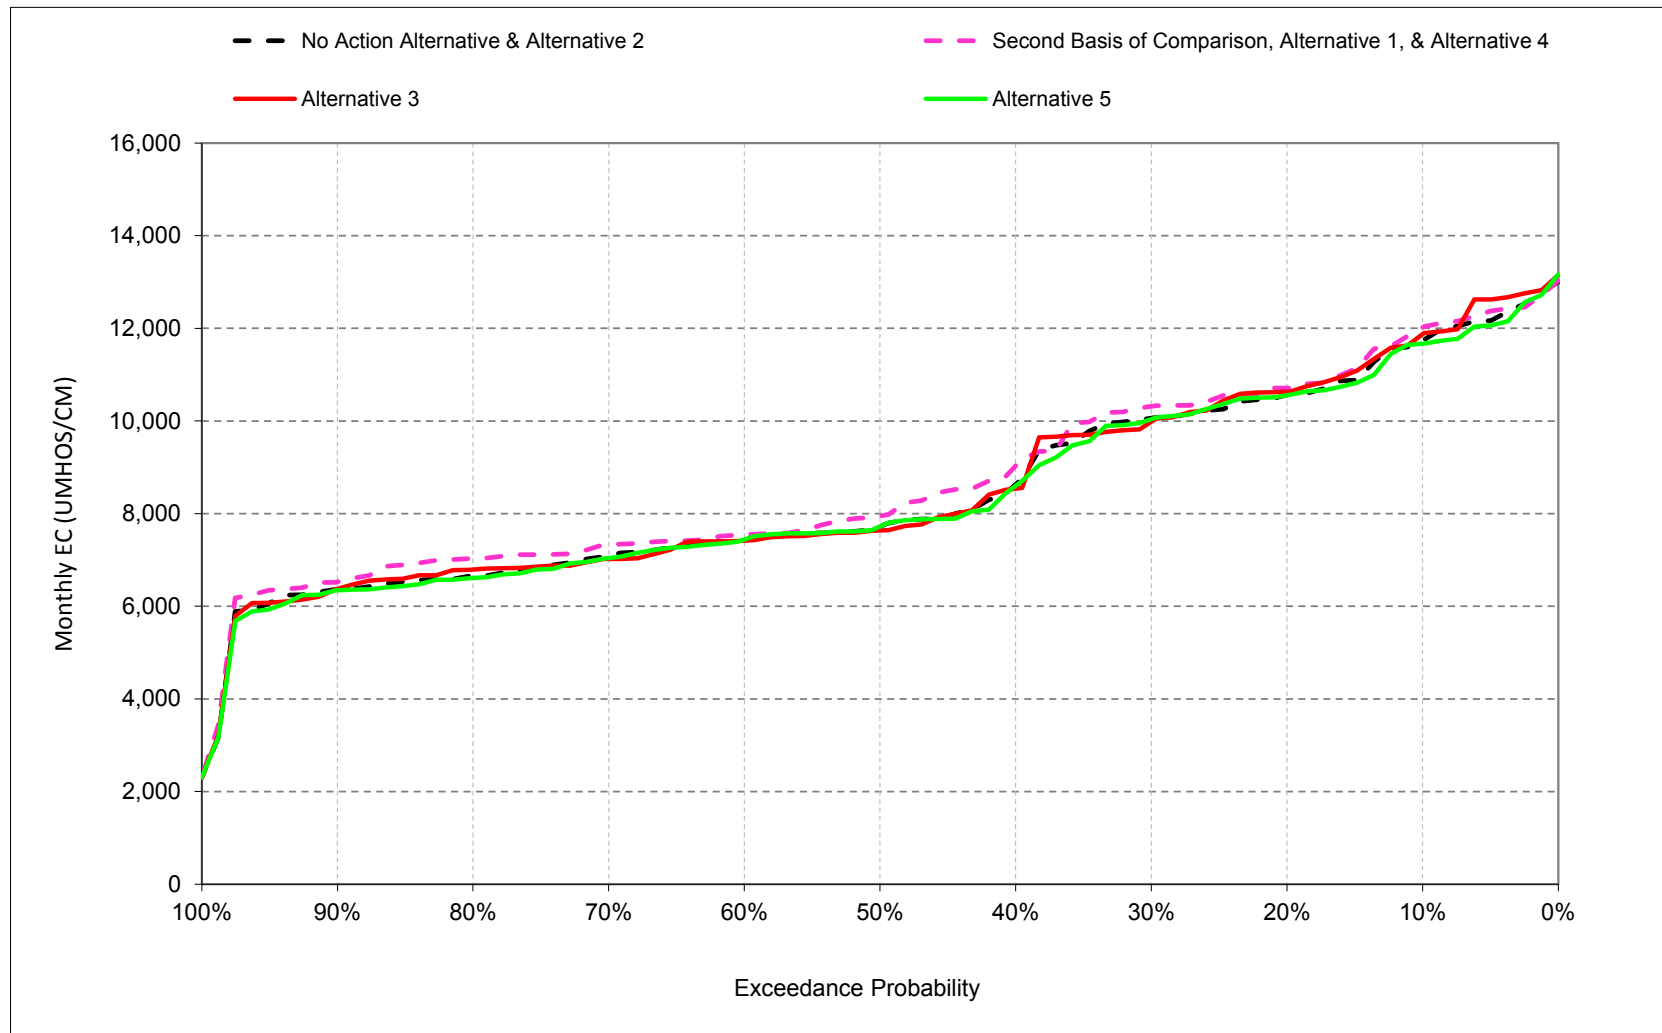

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.10.2.12. Chipps Island South Channel Salinity, Electrical Conductivity, September

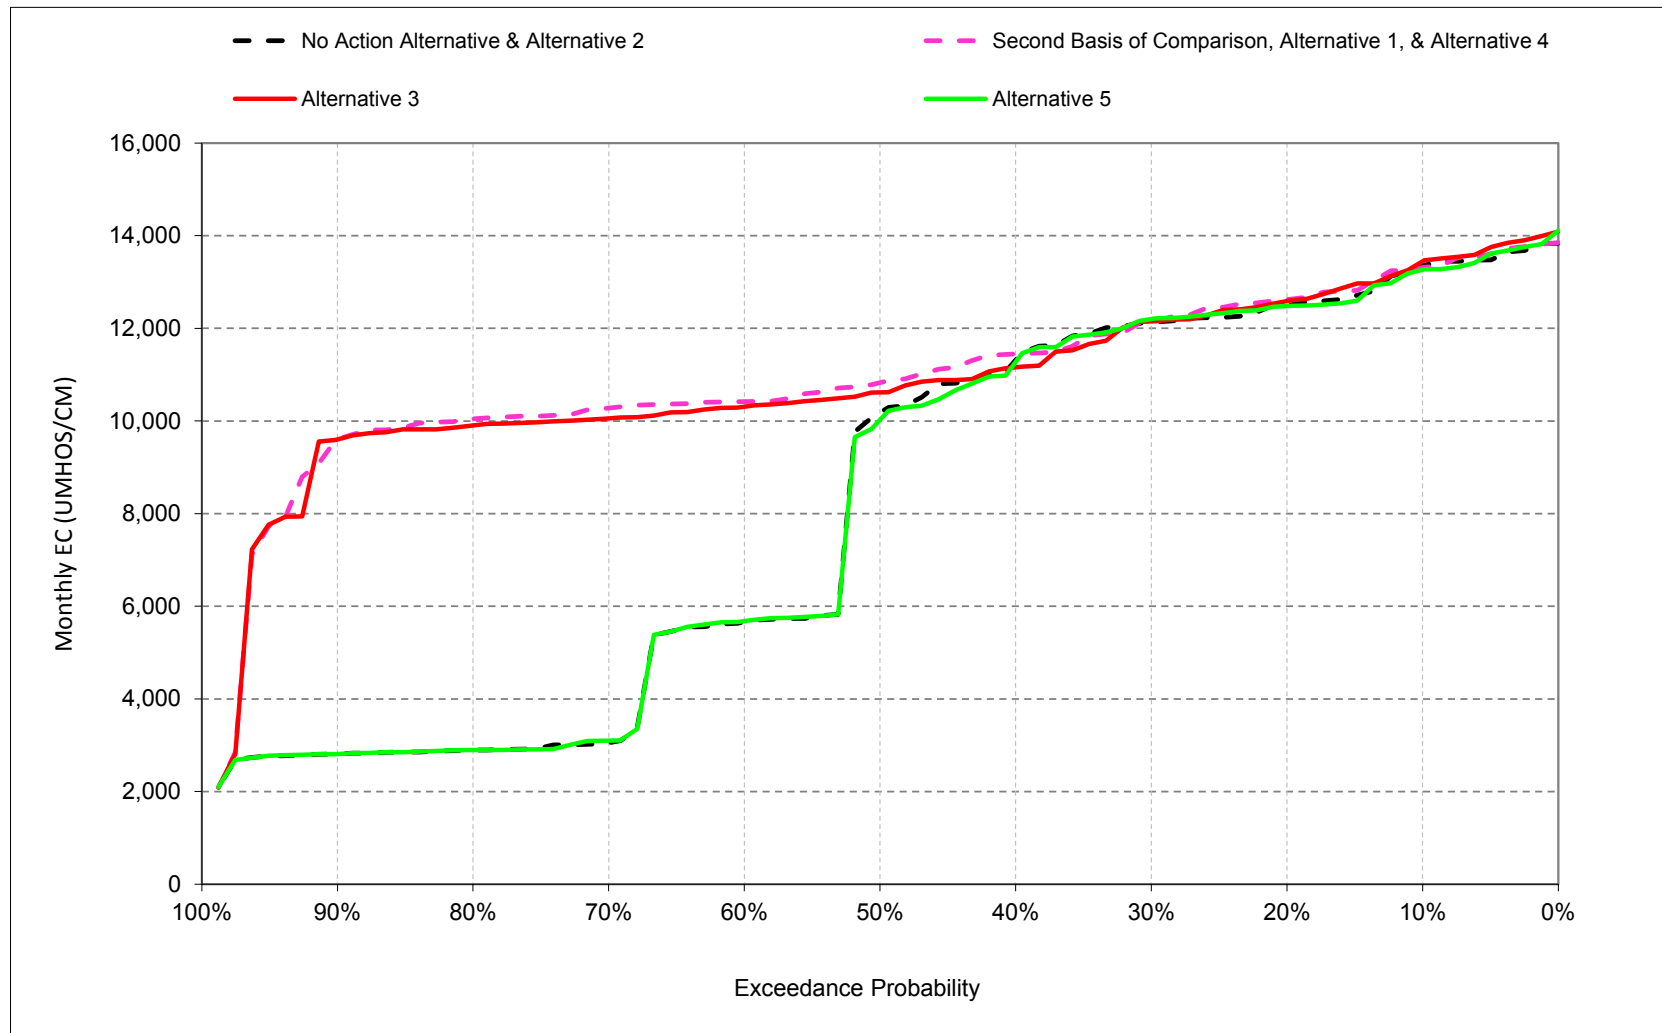

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.10.2.1. Chipps Island South Channel Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	14,923	15,215	12,996	8,123	3,597	2,905	3,911	5,182	6,581	9,468	11,739	13,345
20%	13,685	13,461	11,103	6,886	2,025	2,033	2,266	4,302	5,877	8,101	10,564	12,505
30%	13,564	12,987	7,576	5,487	1,288	822	1,527	3,543	5,435	7,397	10,064	12,129
40%	13,236	11,084	6,541	3,117	807	627	900	1,944	4,826	5,928	8,630	11,317
50%	11,999	5,844	5,602	2,446	485	363	615	1,401	3,825	5,234	7,725	10,183
60%	5,881	5,520	4,997	979	285	246	366	843	3,451	4,094	7,445	5,658
70%	2,777	2,822	2,163	302	217	202	268	578	2,595	3,779	7,097	3,174
80%	2,722	2,517	876	214	200	197	208	290	1,532	3,498	6,655	2,900
90%	2,559	2,419	339	194	191	191	195	192	467	2,918	6,365	2,827
Long Term												
Full Simulation Period ^b	8,838	7,926	6,004	3,373	1,395	1,026	1,357	2,217	4,062	5,689	8,497	8,174
Water Year Types ^c												
Wet (32%)	6,476	5,083	2,035	704	243	242	295	503	1,735	3,032	6,621	2,865
Above Normal (16%)	10,730	8,234	5,322	1,535	420	317	409	906	3,230	3,939	6,801	5,624
Below Normal (13%)	6,567	6,293	6,238	4,033	1,593	1,328	1,582	2,467	4,607	5,412	7,910	10,906
Dry (24%)	9,599	9,319	8,435	5,286	1,998	1,141	1,658	2,936	4,985	7,665	10,197	12,070
Critical (15%)	12,720	12,930	11,078	7,352	3,758	3,023	3,978	5,922	7,969	10,302	12,102	13,439
Alternative 1												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	14,822	15,055	13,036	10,462	5,408	3,992	4,173	5,289	6,601	9,386	12,021	13,311
20%	13,600	13,354	12,822	9,063	3,054	2,188	2,892	4,347	5,722	8,179	10,712	12,621
30%	13,238	13,048	12,042	7,692	2,046	1,037	2,257	4,000	5,007	7,483	10,317	12,155
40%	13,049	12,773	11,213	4,970	1,159	861	1,554	2,694	4,220	5,849	9,034	11,448
50%	12,567	12,393	9,721	3,411	706	481	1,071	2,164	3,763	5,305	7,948	10,828
60%	12,220	11,864	7,171	1,666	314	247	618	1,437	3,367	4,411	7,545	10,417
70%	11,963	11,605	3,644	404	216	205	313	971	2,682	4,094	7,332	10,280
80%	11,581	10,636	1,885	225	197	197	207	353	1,779	3,503	7,028	10,045
90%	10,260	5,768	690	195	191	190	194	193	497	2,963	6,529	9,606
Long Term												
Full Simulation Period ^b	12,243	11,302	7,959	4,361	1,816	1,228	1,640	2,577	3,974	5,799	8,713	10,985
Water Year Types ^c												
Wet (32%)	11,024	9,589	3,355	985	268	252	412	734	1,710	3,186	6,773	9,223
Above Normal (16%)	12,988	11,060	7,745	2,299	571	338	645	1,420	3,065	4,076	7,104	10,226
Below Normal (13%)	11,777	10,507	8,929	6,052	2,454	1,578	2,053	2,977	4,081	5,495	8,367	11,089
Dry (24%)	12,769	12,584	10,894	6,933	2,615	1,421	2,039	3,275	4,939	7,676	10,371	12,213
Critical (15%)	13,627	13,867	12,382	8,070	4,600	3,666	4,337	6,296	8,155	10,478	12,215	13,482
Alternative 1 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-101	-160	40	2,339	1,811	1,087	263	107	20	-81	282	-33
20%	-86	-108	1,719	2,177	1,029	155	625	44	-155	77	148	116
30%	-326	62	4,466	2,206	758	215	729	458	-428	86	253	25
40%	-187	1,689	4,672	1,853	352	234	655	750	-607	-79	404	131
50%	568	6,550	4,119	965	221	119	456	763	-62	70	223	645
60%	6,339	6,344	2,174	687	29	1	251	594	-84	316	101	4,759
70%	9,185	8,783	1,481	102	-1	2	45	393	87	316	235	7,106
80%	8,858	8,120	1,009	12	-3	0	-1	63	247	5	373	7,145
90%	7,701	3,349	351	1	0	-1	-1	1	30	45	164	6,778
Long Term												
Full Simulation Period ^b	3,404	3,375	1,954	988	421	202	283	361	-88	110	217	2,811
Water Year Types ^c												
Wet (32%)	4,547	4,506	1,321	282	25	10	117	231	-25	154	152	6,357
Above Normal (16%)	2,258	2,826	2,423	764	150	21	236	514	-165	137	303	4,602
Below Normal (13%)	5,210	4,214	2,690	2,019	861	250	471	510	-525	83	457	183
Dry (24%)	3,170	3,264	2,460	1,647	617	279	380	339	-46	11	174	142
Critical (15%)	907	936	1,303	717	842	643	359	375	186	176	113	43

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.10.2.2. Chippis Island South Channel Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	14,923	15,215	12,996	8,123	3,597	2,905	3,911	5,182	6,581	9,468	11,739	13,345
20%	13,685	13,461	11,103	6,886	2,025	2,033	2,266	4,302	5,877	8,101	10,564	12,505
30%	13,564	12,987	7,576	5,487	1,288	822	1,527	3,543	5,435	7,397	10,064	12,129
40%	13,236	11,084	6,541	3,117	807	627	900	1,944	4,826	5,928	8,630	11,317
50%	11,999	5,844	5,602	2,446	485	363	615	1,401	3,825	5,234	7,725	10,183
60%	5,881	5,520	4,997	979	285	246	366	843	3,451	4,094	7,445	5,658
70%	2,777	2,822	2,163	302	217	202	268	578	2,595	3,779	7,097	3,174
80%	2,722	2,517	876	214	200	197	208	290	1,532	3,498	6,655	2,900
90%	2,559	2,419	339	194	191	191	195	192	467	2,918	6,365	2,827
Long Term												
Full Simulation Period ^b	8,838	7,926	6,004	3,373	1,395	1,026	1,357	2,217	4,062	5,689	8,497	8,174
Water Year Types ^c												
Wet (32%)	6,476	5,083	2,035	704	243	242	295	503	1,735	3,032	6,621	2,865
Above Normal (16%)	10,730	8,234	5,322	1,535	420	317	409	906	3,230	3,939	6,801	5,624
Below Normal (13%)	6,567	6,293	6,238	4,033	1,593	1,328	1,582	2,467	4,607	5,412	7,910	10,906
Dry (24%)	9,599	9,319	8,435	5,286	1,998	1,141	1,658	2,936	4,985	7,665	10,197	12,070
Critical (15%)	12,720	12,930	11,078	7,352	3,758	3,023	3,978	5,922	7,969	10,302	12,102	13,439
Alternative 3												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	14,730	15,237	13,071	9,206	3,718	2,919	3,852	5,477	6,574	9,195	11,873	13,445
20%	13,719	13,525	12,644	7,905	2,012	2,036	2,747	4,486	5,930	8,091	10,630	12,592
30%	13,433	13,082	12,030	6,725	1,349	812	1,885	3,928	5,447	7,518	9,985	12,150
40%	12,988	12,893	10,924	3,530	788	697	1,436	2,943	5,001	5,709	8,541	11,162
50%	12,486	12,515	9,681	2,518	485	404	987	2,369	4,223	5,321	7,634	10,617
60%	12,175	11,960	7,215	1,088	256	244	610	1,630	3,643	4,149	7,418	10,306
70%	11,928	11,678	2,772	290	213	203	345	975	2,917	3,833	7,021	10,056
80%	11,595	10,530	1,839	217	198	196	207	429	2,012	3,600	6,794	9,902
90%	10,651	5,537	766	194	191	190	192	193	600	3,014	6,374	9,689
Long Term												
Full Simulation Period ^b	12,307	11,415	7,810	3,769	1,420	1,030	1,537	2,611	4,245	5,737	8,531	10,896
Water Year Types ^c												
Wet (32%)	10,964	9,659	3,229	797	245	257	412	809	1,960	3,118	6,581	9,170
Above Normal (16%)	13,230	11,164	7,397	1,780	395	309	608	1,488	3,440	4,019	6,911	10,145
Below Normal (13%)	11,958	10,730	8,952	4,752	1,640	1,329	1,906	3,045	4,843	5,408	7,856	10,669
Dry (24%)	12,730	12,672	10,816	5,938	1,993	1,139	1,860	3,323	5,116	7,603	10,258	12,181
Critical (15%)	13,833	14,027	12,129	7,848	3,919	3,028	4,101	6,151	8,068	10,466	12,252	13,519
Alternative 3 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-193	22	76	1,083	120	14	-59	295	-7	-273	133	100
20%	33	63	1,540	1,019	-13	3	481	184	53	-10	67	87
30%	-131	95	4,454	1,238	61	-11	358	385	12	121	-79	21
40%	-248	1,809	4,383	413	-19	69	536	999	174	-219	-89	-155
50%	487	6,671	4,079	71	0	41	372	968	399	87	-91	434
60%	6,295	6,440	2,218	109	-29	-2	244	787	192	55	-26	4,649
70%	9,151	8,856	609	-12	-4	1	77	397	322	54	-76	6,882
80%	8,873	8,013	963	4	-2	-1	-1	139	480	102	139	7,001
90%	8,092	3,117	427	0	0	-1	-3	1	133	96	9	6,862
Long Term												
Full Simulation Period ^b	3,469	3,489	1,806	396	25	4	179	395	183	48	34	2,723
Water Year Types ^c												
Wet (32%)	4,488	4,576	1,194	94	2	15	117	306	225	86	-41	6,304
Above Normal (16%)	2,500	2,929	2,075	245	-25	-8	199	582	210	80	111	4,521
Below Normal (13%)	5,390	4,437	2,714	719	47	1	324	578	237	-5	-54	-237
Dry (24%)	3,130	3,353	2,381	652	-5	-2	202	386	131	-61	61	111
Critical (15%)	1,113	1,097	1,051	495	161	5	122	229	99	163	150	80

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.10.2.3. Chippis Island South Channel Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	14,923	15,215	12,996	8,123	3,597	2,905	3,911	5,182	6,581	9,468	11,739	13,345
20%	13,685	13,461	11,103	6,886	2,025	2,033	2,266	4,302	5,877	8,101	10,564	12,505
30%	13,564	12,987	7,576	5,487	1,288	822	1,527	3,543	5,435	7,397	10,064	12,129
40%	13,236	11,084	6,541	3,117	807	627	900	1,944	4,826	5,928	8,630	11,317
50%	11,999	5,844	5,602	2,446	485	363	615	1,401	3,825	5,234	7,725	10,183
60%	5,881	5,520	4,997	979	285	246	366	843	3,451	4,094	7,445	5,658
70%	2,777	2,822	2,163	302	217	202	268	578	2,595	3,779	7,097	3,174
80%	2,722	2,517	876	214	200	197	208	290	1,532	3,498	6,655	2,900
90%	2,559	2,419	339	194	191	191	195	192	467	2,918	6,365	2,827
Long Term												
Full Simulation Period ^b	8,838	7,926	6,004	3,373	1,395	1,026	1,357	2,217	4,062	5,689	8,497	8,174
Water Year Types ^c												
Wet (32%)	6,476	5,083	2,035	704	243	242	295	503	1,735	3,032	6,621	2,865
Above Normal (16%)	10,730	8,234	5,322	1,535	420	317	409	906	3,230	3,939	6,801	5,624
Below Normal (13%)	6,567	6,293	6,238	4,033	1,593	1,328	1,582	2,467	4,607	5,412	7,910	10,906
Dry (24%)	9,599	9,319	8,435	5,286	1,998	1,141	1,658	2,936	4,985	7,665	10,197	12,070
Critical (15%)	12,720	12,930	11,078	7,352	3,758	3,023	3,978	5,922	7,969	10,302	12,102	13,439
Alternative 5												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	14,965	15,101	13,021	8,114	3,598	2,909	3,394	4,277	6,390	9,327	11,666	13,266
20%	13,775	13,474	10,924	6,904	2,043	2,064	2,131	3,732	5,548	7,867	10,555	12,480
30%	13,580	12,987	7,592	5,487	1,285	835	1,403	2,952	5,310	7,323	10,041	12,201
40%	13,097	11,051	6,536	3,116	800	625	835	1,842	4,622	5,932	8,600	11,269
50%	11,913	5,812	5,619	2,452	485	369	604	1,289	3,811	5,250	7,720	10,026
60%	5,878	5,390	4,995	976	284	246	366	866	3,466	4,101	7,439	5,679
70%	2,779	2,821	2,171	295	217	202	269	537	2,579	3,787	7,040	3,181
80%	2,726	2,515	881	214	200	197	208	280	1,528	3,500	6,611	2,898
90%	2,567	2,384	338	194	191	191	195	192	468	2,917	6,348	2,831
Long Term												
Full Simulation Period ^b	8,829	7,898	6,004	3,399	1,418	1,030	1,231	1,978	3,919	5,633	8,445	8,159
Water Year Types ^c												
Wet (32%)	6,473	5,103	2,038	703	243	242	292	478	1,724	2,999	6,563	2,867
Above Normal (16%)	10,711	8,063	5,264	1,532	420	317	407	880	3,211	3,938	6,799	5,641
Below Normal (13%)	6,579	6,299	6,245	4,039	1,594	1,329	1,435	2,222	4,523	5,392	7,863	10,831
Dry (24%)	9,589	9,298	8,464	5,317	2,007	1,145	1,435	2,575	4,806	7,615	10,148	12,055
Critical (15%)	12,691	12,908	11,082	7,477	3,899	3,045	3,632	5,196	7,408	10,096	11,997	13,410
Alternative 5 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	42	-114	26	-9	1	4	-516	-905	-191	-141	-73	-78
20%	90	13	-179	18	18	31	-135	-570	-329	-235	-9	-25
30%	16	0	16	0	-2	13	-124	-591	-125	-74	-23	72
40%	-140	-33	-5	-1	-7	-2	-65	-101	-205	4	-30	-48
50%	-86	-32	17	6	0	7	-11	-112	-13	15	-5	-157
60%	-3	-130	-2	-3	0	0	0	23	15	6	-5	21
70%	2	-1	8	-7	0	0	1	-42	-16	8	-58	7
80%	3	-2	5	0	0	0	1	-10	-4	2	-44	-3
90%	9	-36	-1	0	0	0	0	0	1	0	-16	4
Long Term												
Full Simulation Period ^b	-9	-28	0	26	23	4	-126	-239	-144	-56	-52	-15
Water Year Types ^c												
Wet (32%)	-3	20	3	0	0	0	-3	-25	-11	-33	-58	2
Above Normal (16%)	-19	-171	-58	-3	0	0	-1	-27	-19	-1	-2	18
Below Normal (13%)	12	6	6	7	0	1	-147	-245	-83	-20	-47	-75
Dry (24%)	-11	-22	29	31	10	3	-223	-361	-179	-49	-49	-15
Critical (15%)	-29	-22	3	125	141	22	-346	-725	-561	-207	-105	-29
<p>^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.</p> <p>^b Based on the 82-year simulation period.</p> <p>^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.</p> <p>Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.</p>												

Table 6E.B.10.2.4. Chippis Island South Channel Salinity, Monthly EC

Second Basis of Comparison												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	14,822	15,055	13,036	10,462	5,408	3,992	4,173	5,289	6,601	9,386	12,021	13,311
20%	13,600	13,354	12,822	9,063	3,054	2,188	2,892	4,347	5,722	8,179	10,712	12,621
30%	13,238	13,048	12,042	7,692	2,046	1,037	2,257	4,000	5,007	7,483	10,317	12,155
40%	13,049	12,773	11,213	4,970	1,159	861	1,554	2,694	4,220	5,849	9,034	11,448
50%	12,567	12,393	9,721	3,411	706	481	1,071	2,164	3,763	5,305	7,948	10,828
60%	12,220	11,864	7,171	1,666	314	247	618	1,437	3,367	4,411	7,545	10,417
70%	11,963	11,605	3,644	404	216	205	313	971	2,682	4,094	7,332	10,280
80%	11,581	10,636	1,885	225	197	197	207	353	1,779	3,503	7,028	10,045
90%	10,260	5,768	690	195	191	190	194	193	497	2,963	6,529	9,606
Long Term												
Full Simulation Period ^b	12,243	11,302	7,959	4,361	1,816	1,228	1,640	2,577	3,974	5,799	8,713	10,985
Water Year Types^c												
Wet (32%)	11,024	9,589	3,355	985	268	252	412	734	1,710	3,186	6,773	9,223
Above Normal (16%)	12,988	11,060	7,745	2,299	571	338	645	1,420	3,065	4,076	7,104	10,226
Below Normal (13%)	11,777	10,507	8,929	6,052	2,454	1,578	2,053	2,977	4,081	5,495	8,367	11,089
Dry (24%)	12,769	12,584	10,894	6,933	2,615	1,421	2,039	3,275	4,939	7,676	10,371	12,213
Critical (15%)	13,627	13,867	12,382	8,070	4,600	3,666	4,337	6,296	8,155	10,478	12,215	13,482
No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	14,923	15,215	12,996	8,123	3,597	2,905	3,911	5,182	6,581	9,468	11,739	13,345
20%	13,685	13,461	11,103	6,886	2,025	2,033	2,266	4,302	5,877	8,101	10,564	12,505
30%	13,564	12,987	7,576	5,487	1,288	822	1,527	3,543	5,435	7,397	10,064	12,129
40%	13,236	11,084	6,541	3,117	807	627	900	1,944	4,826	5,928	8,630	11,317
50%	11,999	5,844	5,602	2,446	485	363	615	1,401	3,825	5,234	7,725	10,183
60%	5,881	5,520	4,997	979	285	246	366	843	3,451	4,094	7,445	5,658
70%	2,777	2,822	2,163	302	217	202	268	578	2,595	3,779	7,097	3,174
80%	2,722	2,517	876	214	200	197	208	290	1,532	3,498	6,655	2,900
90%	2,559	2,419	339	194	191	191	195	192	467	2,918	6,365	2,827
Long Term												
Full Simulation Period ^b	8,838	7,926	6,004	3,373	1,395	1,026	1,357	2,217	4,062	5,689	8,497	8,174
Water Year Types^c												
Wet (32%)	6,476	5,083	2,035	704	243	242	295	503	1,735	3,032	6,621	2,865
Above Normal (16%)	10,730	8,234	5,322	1,535	420	317	409	906	3,230	3,939	6,801	5,624
Below Normal (13%)	6,567	6,293	6,238	4,033	1,593	1,328	1,582	2,467	4,607	5,412	7,910	10,906
Dry (24%)	9,599	9,319	8,435	5,286	1,998	1,141	1,658	2,936	4,985	7,665	10,197	12,070
Critical (15%)	12,720	12,930	11,078	7,352	3,758	3,023	3,978	5,922	7,969	10,302	12,102	13,439
No Action Alternative minus Second Basis of Comparison												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	101	160	-40	-2,339	-1,811	-1,087	-263	-107	-20	81	-282	33
20%	86	108	-1,719	-2,177	-1,029	-155	-625	-44	155	-77	-148	-116
30%	326	-62	-4,466	-2,206	-758	-215	-729	-458	428	-86	-253	-25
40%	187	-1,689	-4,672	-1,853	-352	-234	-655	-750	607	79	-404	-131
50%	-568	-6,550	-4,119	-965	-221	-119	-456	-763	62	-70	-223	-645
60%	-6,339	-6,344	-2,174	-687	-29	-1	-251	-594	84	-316	-101	-4,759
70%	-9,185	-8,783	-1,481	-102	1	-2	-45	-393	-87	-316	-235	-7,106
80%	-8,858	-8,120	-1,009	-12	3	0	1	-63	-247	-5	-373	-7,145
90%	-7,701	-3,349	-351	-1	0	1	1	-1	-30	-45	-164	-6,778
Long Term												
Full Simulation Period ^b	-3,404	-3,375	-1,954	-988	-421	-202	-283	-361	88	-110	-217	-2,811
Water Year Types^c												
Wet (32%)	-4,547	-4,506	-1,321	-282	-25	-10	-117	-231	25	-154	-152	-6,357
Above Normal (16%)	-2,258	-2,826	-2,423	-764	-150	-21	-236	-514	165	-137	-303	-4,602
Below Normal (13%)	-5,210	-4,214	-2,690	-2,019	-861	-250	-471	-510	525	-83	-457	-183
Dry (24%)	-3,170	-3,264	-2,460	-1,647	-617	-279	-380	-339	46	-11	-174	-142
Critical (15%)	-907	-936	-1,303	-717	-842	-643	-359	-375	-186	-176	-113	-43

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.10.2.5. Chippis Island South Channel Salinity, Monthly EC

Second Basis of Comparison												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	14,822	15,055	13,036	10,462	5,408	3,992	4,173	5,289	6,601	9,386	12,021	13,311
20%	13,600	13,354	12,822	9,063	3,054	2,188	2,892	4,347	5,722	8,179	10,712	12,621
30%	13,238	13,048	12,042	7,692	2,046	1,037	2,257	4,000	5,007	7,483	10,317	12,155
40%	13,049	12,773	11,213	4,970	1,159	861	1,554	2,694	4,220	5,849	9,034	11,448
50%	12,567	12,393	9,721	3,411	706	481	1,071	2,164	3,763	5,305	7,948	10,828
60%	12,220	11,864	7,171	1,666	314	247	618	1,437	3,367	4,411	7,545	10,417
70%	11,963	11,605	3,644	404	216	205	313	971	2,682	4,094	7,332	10,280
80%	11,581	10,636	1,885	225	197	197	207	353	1,779	3,503	7,028	10,045
90%	10,260	5,768	690	195	191	190	194	193	497	2,963	6,529	9,606
Long Term												
Full Simulation Period ^b	12,243	11,302	7,959	4,361	1,816	1,228	1,640	2,577	3,974	5,799	8,713	10,985
Water Year Types^c												
Wet (32%)	11,024	9,589	3,355	985	268	252	412	734	1,710	3,186	6,773	9,223
Above Normal (16%)	12,988	11,060	7,745	2,299	571	338	645	1,420	3,065	4,076	7,104	10,226
Below Normal (13%)	11,777	10,507	8,929	6,052	2,454	1,578	2,053	2,977	4,081	5,495	8,367	11,089
Dry (24%)	12,769	12,584	10,894	6,933	2,615	1,421	2,039	3,275	4,939	7,676	10,371	12,213
Critical (15%)	13,627	13,867	12,382	8,070	4,600	3,666	4,337	6,296	8,155	10,478	12,215	13,482

Alternative 3

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	14,730	15,237	13,071	9,206	3,718	2,919	3,852	5,477	6,574	9,195	11,873	13,445
20%	13,719	13,525	12,644	7,905	2,012	2,036	2,747	4,486	5,930	8,091	10,630	12,592
30%	13,433	13,082	12,030	6,725	1,349	812	1,885	3,928	5,447	7,518	9,985	12,150
40%	12,988	12,893	10,924	3,530	788	697	1,436	2,943	5,001	5,709	8,541	11,162
50%	12,486	12,515	9,681	2,518	485	404	987	2,369	4,223	5,321	7,634	10,617
60%	12,175	11,960	7,215	1,088	256	244	610	1,630	3,643	4,149	7,418	10,306
70%	11,928	11,678	2,772	290	213	203	345	975	2,917	3,833	7,021	10,056
80%	11,595	10,530	1,839	217	198	196	207	429	2,012	3,600	6,794	9,902
90%	10,651	5,537	766	194	191	190	192	193	600	3,014	6,374	9,689
Long Term												
Full Simulation Period ^b	12,307	11,415	7,810	3,769	1,420	1,030	1,537	2,611	4,245	5,737	8,531	10,896
Water Year Types^c												
Wet (32%)	10,964	9,659	3,229	797	245	257	412	809	1,960	3,118	6,581	9,170
Above Normal (16%)	13,230	11,164	7,397	1,780	395	309	608	1,488	3,440	4,019	6,911	10,145
Below Normal (13%)	11,958	10,730	8,952	4,752	1,640	1,329	1,906	3,045	4,843	5,408	7,856	10,669
Dry (24%)	12,730	12,672	10,816	5,938	1,993	1,139	1,860	3,323	5,116	7,603	10,258	12,181
Critical (15%)	13,833	14,027	12,129	7,848	3,919	3,028	4,101	6,151	8,068	10,466	12,252	13,519

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-93	182	36	-1,256	-1,690	-1,073	-322	188	-27	-192	-148	133
20%	119	171	-178	-1,158	-1,042	-152	-145	139	208	-87	-82	-29
30%	195	34	-12	-968	-697	-226	-372	-72	439	35	-331	-4
40%	-61	120	-289	-1,440	-371	-165	-119	249	781	-140	-493	-286
50%	-81	121	-40	-894	-221	-77	-84	205	460	17	-313	-211
60%	-45	96	44	-578	-58	-3	-7	193	276	-261	-127	-111
70%	-34	74	-872	-113	-3	-1	32	4	235	-262	-312	-224
80%	15	-107	-47	-8	1	-1	-1	76	233	97	-234	-144
90%	391	-232	76	-1	1	0	-1	0	103	51	-155	83
Long Term												
Full Simulation Period ^b	64	114	-148	-592	-396	-198	-104	34	271	-62	-182	-88
Water Year Types^c												
Wet (32%)	-60	70	-126	-188	-23	5	0	75	250	-68	-193	-53
Above Normal (16%)	242	104	-348	-519	-176	-28	-37	68	375	-56	-192	-81
Below Normal (13%)	180	223	24	-1,300	-814	-249	-147	68	762	-88	-511	-420
Dry (24%)	-39	89	-78	-995	-622	-282	-178	48	178	-72	-113	-31
Critical (15%)	206	160	-253	-222	-681	-638	-237	-146	-87	-13	36	37

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.10.2.6. Chipps Island South Channel Salinity, Monthly EC

Second Basis of Comparison												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	14,822	15,055	13,036	10,462	5,408	3,992	4,173	5,289	6,601	9,386	12,021	13,311
20%	13,600	13,354	12,822	9,063	3,054	2,188	2,892	4,347	5,722	8,179	10,712	12,621
30%	13,238	13,048	12,042	7,692	2,046	1,037	2,257	4,000	5,007	7,483	10,317	12,155
40%	13,049	12,773	11,213	4,970	1,159	861	1,554	2,694	4,220	5,849	9,034	11,448
50%	12,567	12,393	9,721	3,411	706	481	1,071	2,164	3,763	5,305	7,948	10,828
60%	12,220	11,864	7,171	1,666	314	247	618	1,437	3,367	4,411	7,545	10,417
70%	11,963	11,605	3,644	404	216	205	313	971	2,682	4,094	7,332	10,280
80%	11,581	10,636	1,885	225	197	197	207	353	1,779	3,503	7,028	10,045
90%	10,260	5,768	690	195	191	190	194	193	497	2,963	6,529	9,606
Long Term												
Full Simulation Period ^b	12,243	11,302	7,959	4,361	1,816	1,228	1,640	2,577	3,974	5,799	8,713	10,985
Water Year Types ^c												
Wet (32%)	11,024	9,589	3,355	985	268	252	412	734	1,710	3,186	6,773	9,223
Above Normal (16%)	12,988	11,060	7,745	2,299	571	338	645	1,420	3,065	4,076	7,104	10,226
Below Normal (13%)	11,777	10,507	8,929	6,052	2,454	1,578	2,053	2,977	4,081	5,495	8,367	11,089
Dry (24%)	12,769	12,584	10,894	6,933	2,615	1,421	2,039	3,275	4,939	7,676	10,371	12,213
Critical (15%)	13,627	13,867	12,382	8,070	4,600	3,666	4,337	6,296	8,155	10,478	12,215	13,482

Alternative 5

Alternative 5												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	14,965	15,101	13,021	8,114	3,598	2,909	3,394	4,277	6,390	9,327	11,666	13,266
20%	13,775	13,474	10,924	6,904	2,043	2,064	2,131	3,732	5,548	7,867	10,555	12,480
30%	13,580	12,987	7,592	5,487	1,285	835	1,403	2,952	5,310	7,323	10,041	12,201
40%	13,097	11,051	6,536	3,116	800	625	835	1,842	4,622	5,932	8,600	11,269
50%	11,913	5,812	5,619	2,452	485	369	604	1,289	3,811	5,250	7,720	10,026
60%	5,878	5,390	4,995	976	284	246	366	866	3,466	4,101	7,439	5,679
70%	2,779	2,821	2,171	295	217	202	269	537	2,579	3,787	7,040	3,181
80%	2,726	2,515	881	214	200	197	208	280	1,528	3,500	6,611	2,898
90%	2,567	2,384	338	194	191	191	195	192	468	2,917	6,348	2,831
Long Term												
Full Simulation Period ^b	8,829	7,898	6,004	3,399	1,418	1,030	1,231	1,978	3,919	5,633	8,445	8,159
Water Year Types ^c												
Wet (32%)	6,473	5,103	2,038	703	243	242	292	478	1,724	2,999	6,563	2,867
Above Normal (16%)	10,711	8,063	5,264	1,532	420	317	407	880	3,211	3,938	6,799	5,641
Below Normal (13%)	6,579	6,299	6,245	4,039	1,594	1,329	1,435	2,222	4,523	5,392	7,863	10,831
Dry (24%)	9,589	9,298	8,464	5,317	2,007	1,145	1,435	2,575	4,806	7,615	10,148	12,055
Critical (15%)	12,691	12,908	11,082	7,477	3,899	3,045	3,632	5,196	7,408	10,096	11,997	13,410

Alternative 5 minus Second Basis of Comparison

Alternative 5 minus Second Basis of Comparison												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	143	46	-15	-2,348	-1,810	-1,083	-779	-1,012	-211	-60	-355	-45
20%	176	120	-1,898	-2,159	-1,011	-124	-761	-615	-174	-312	-157	-141
30%	342	-61	-4,450	-2,206	-760	-202	-853	-1,048	303	-160	-275	47
40%	48	-1,722	-4,677	-1,854	-359	-236	-720	-852	402	83	-434	-178
50%	-654	-6,581	-4,103	-960	-221	-112	-467	-875	48	-55	-227	-802
60%	-6,342	-6,474	-2,176	-690	-30	-2	-251	-571	98	-310	-106	-4,738
70%	-9,184	-8,783	-1,473	-108	2	-2	-43	-435	-103	-307	-293	-7,099
80%	-8,855	-8,121	-1,004	-11	3	0	1	-73	-251	-3	-417	-7,148
90%	-7,693	-3,385	-352	-1	1	1	1	-1	-29	-45	-181	-6,774
Long Term												
Full Simulation Period ^b	-3,414	-3,404	-1,954	-962	-398	-198	-409	-600	-55	-166	-269	-2,825
Water Year Types ^c												
Wet (32%)	-4,550	-4,486	-1,318	-282	-25	-10	-120	-256	13	-187	-210	-6,355
Above Normal (16%)	-2,277	-2,997	-2,481	-767	-150	-20	-238	-540	146	-138	-305	-4,585
Below Normal (13%)	-5,198	-4,208	-2,684	-2,012	-861	-250	-618	-755	442	-103	-504	-258
Dry (24%)	-3,180	-3,286	-2,430	-1,616	-607	-276	-604	-700	-132	-61	-223	-157
Critical (15%)	-936	-958	-1,300	-593	-701	-621	-705	-1,100	-747	-383	-218	-72

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 **B.11 Old River at Rock Slough Salinity**

Figure 6E.B.11.1. Old River at Rock Slough Salinity, Electrical Conductivity, October

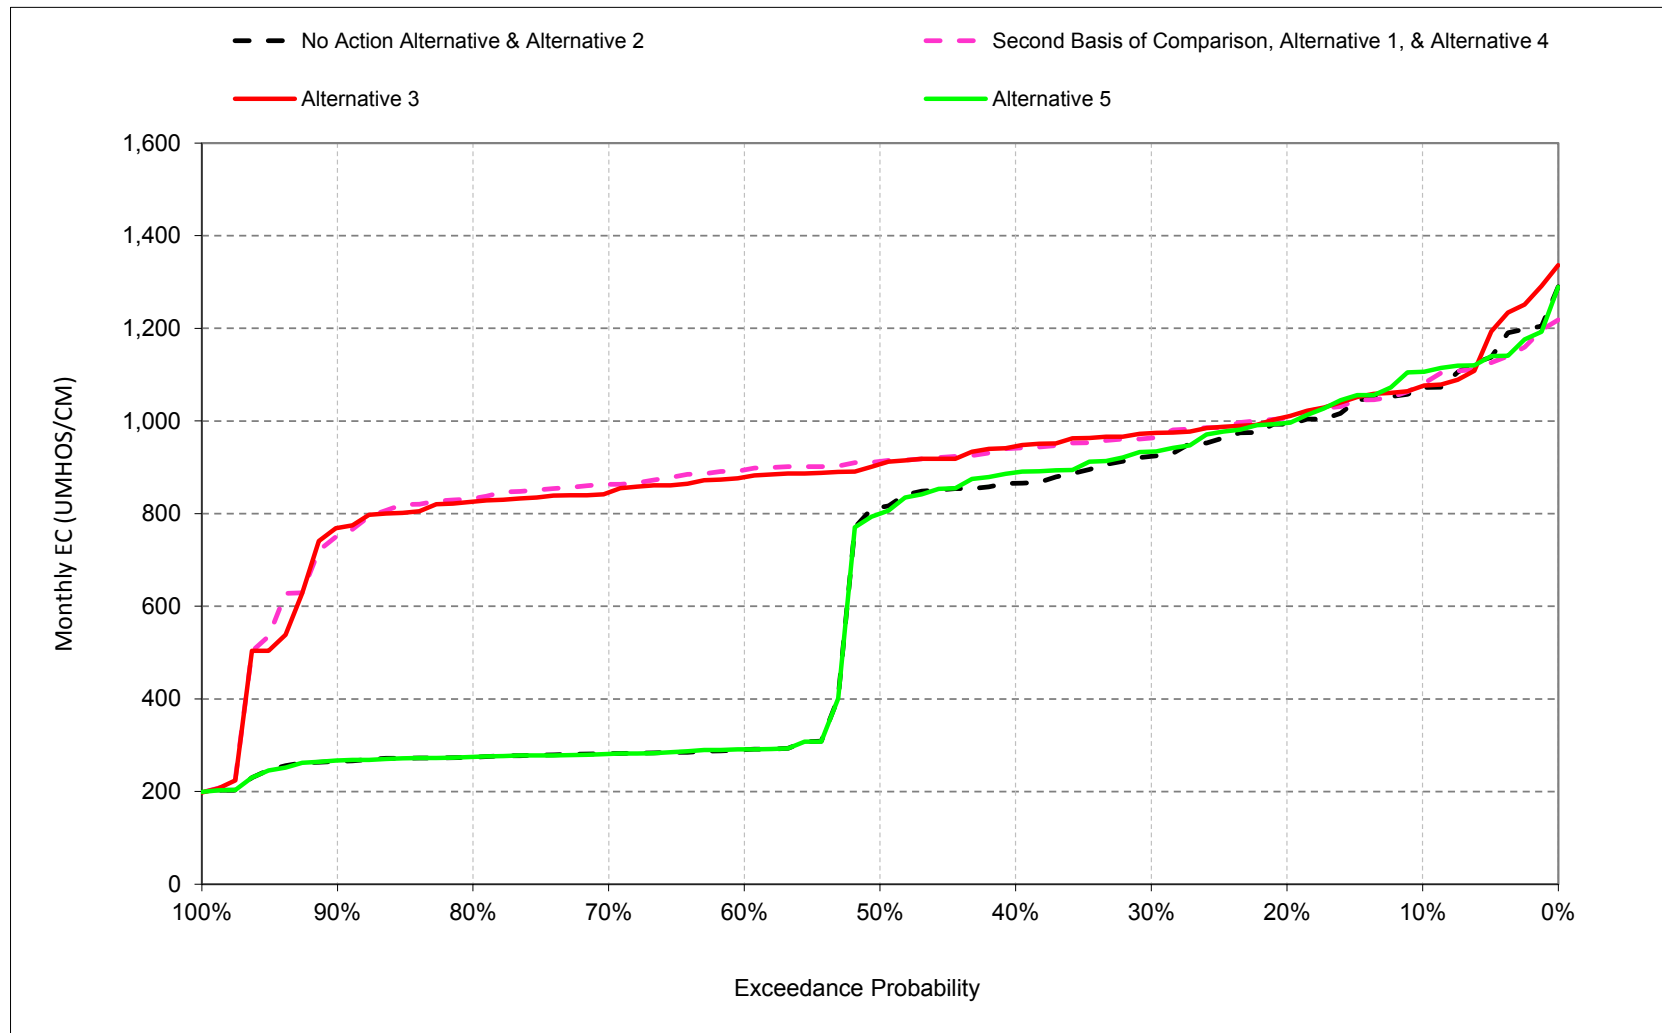


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.11.2. Old River at Rock Slough Salinity, Electrical Conductivity, November

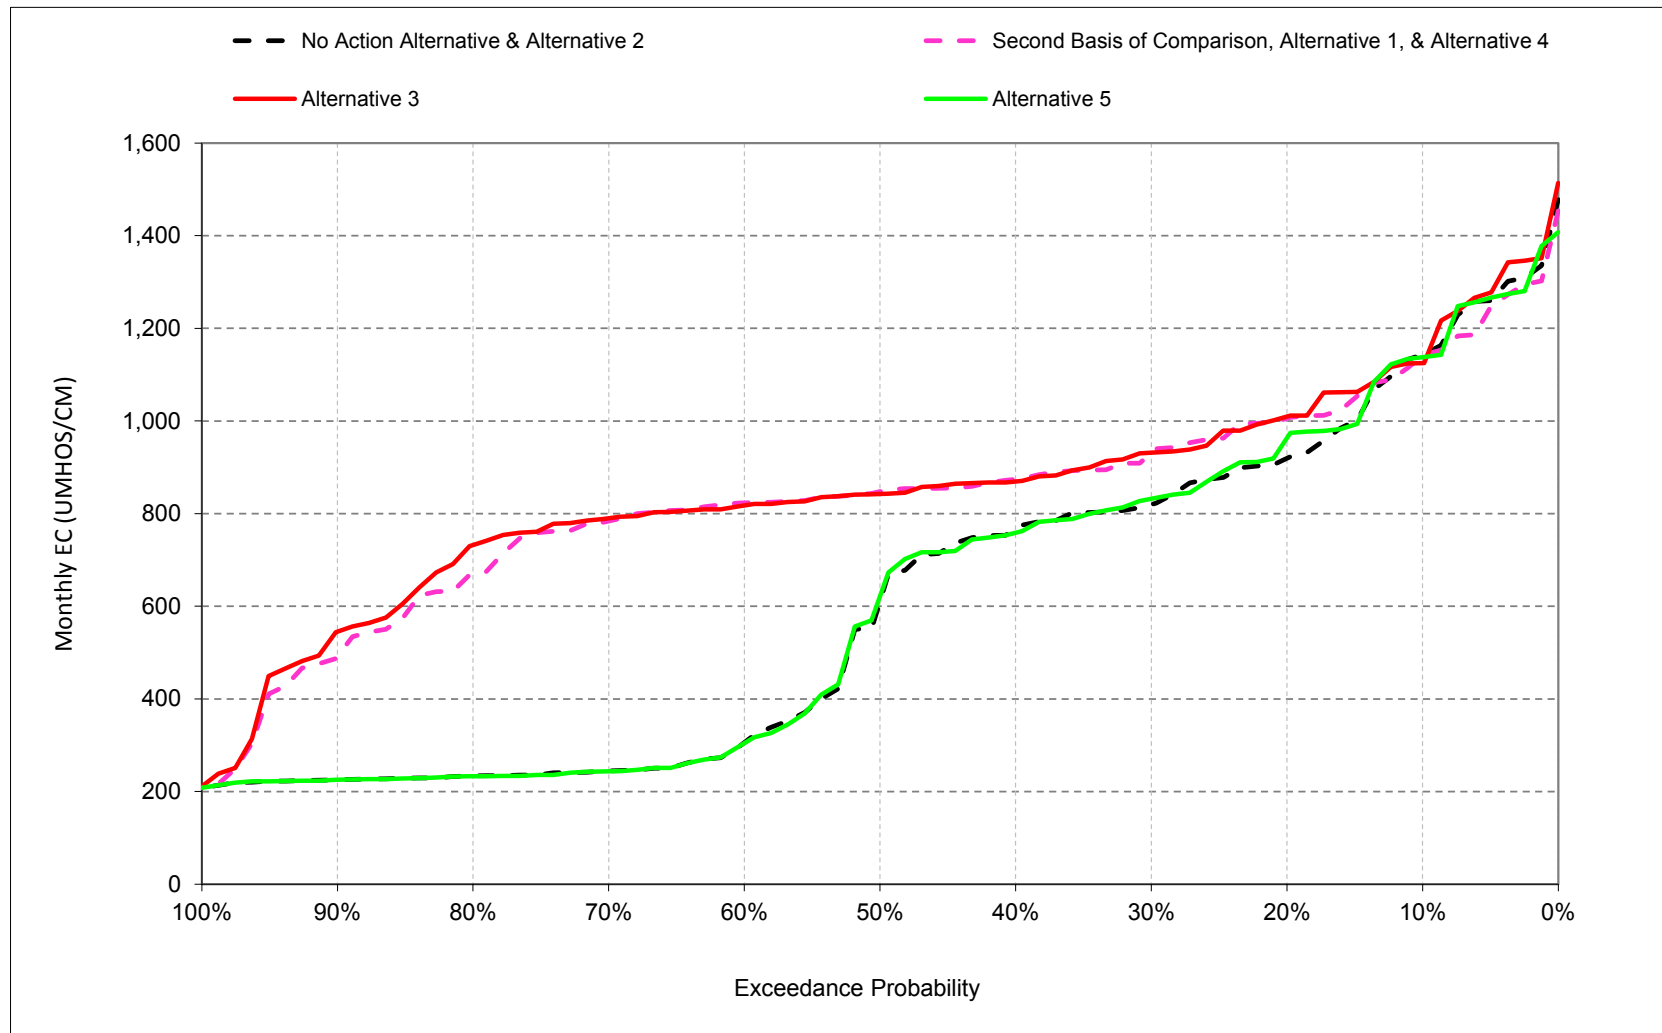


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.11.3. Old River at Rock Slough Salinity, Electrical Conductivity, December

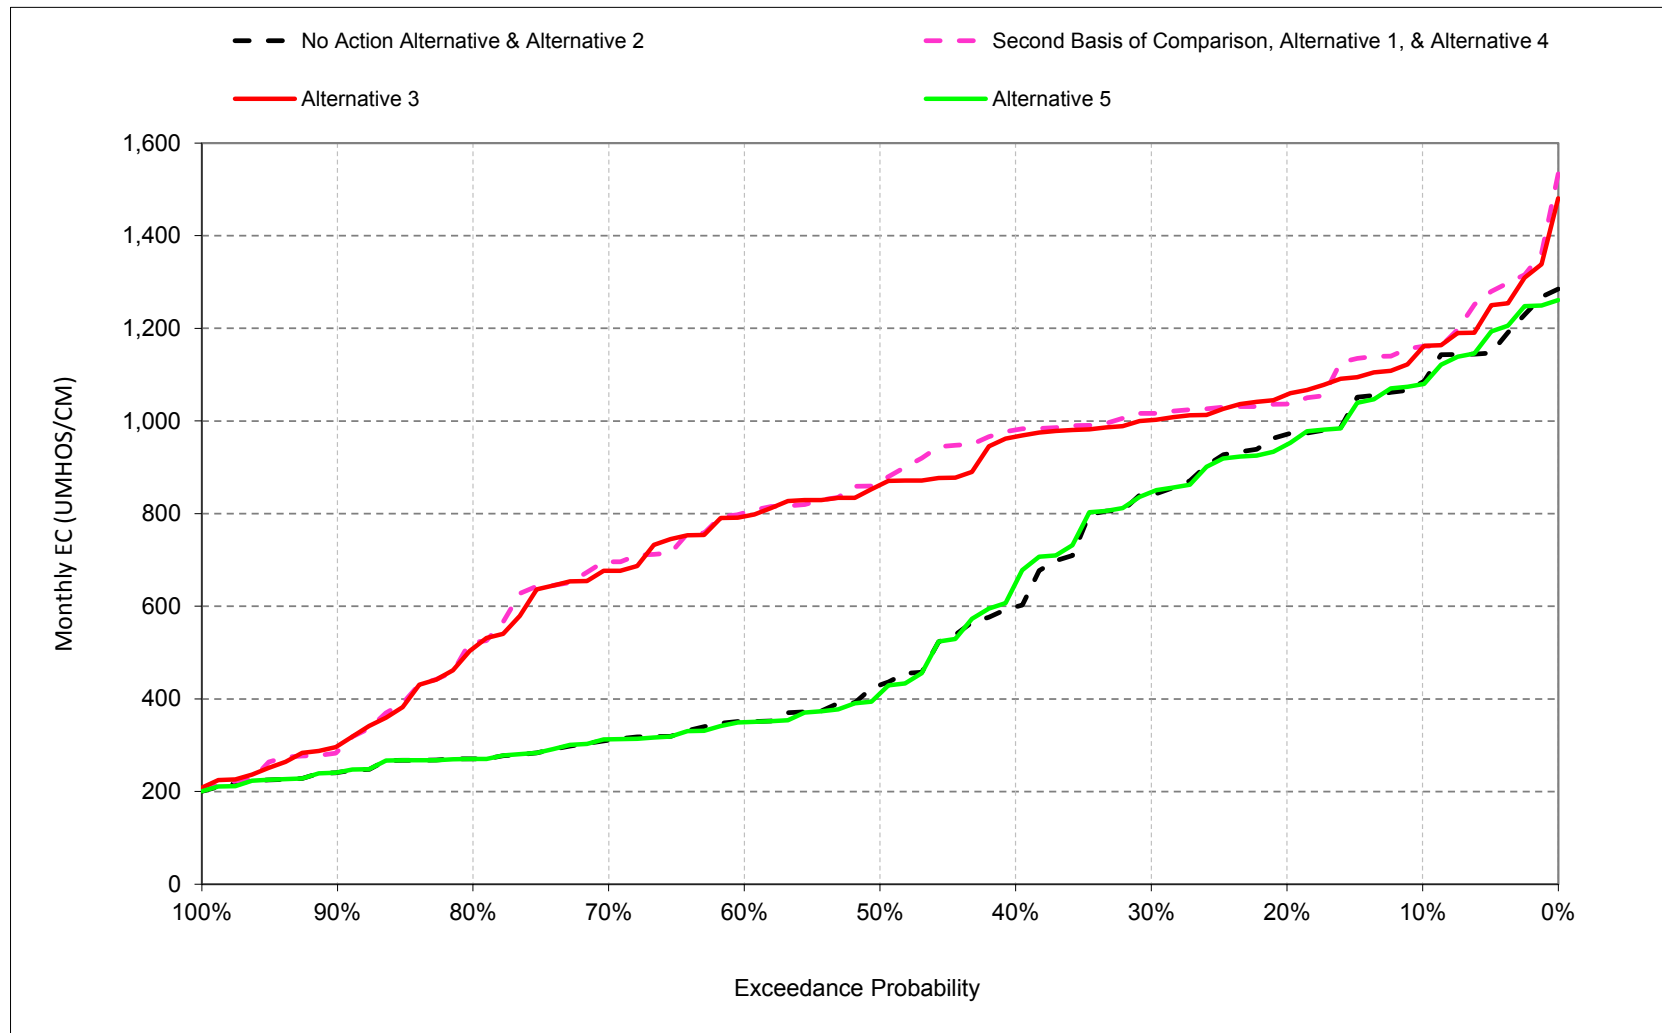


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.11.4. Old River at Rock Slough Salinity, Electrical Conductivity, January

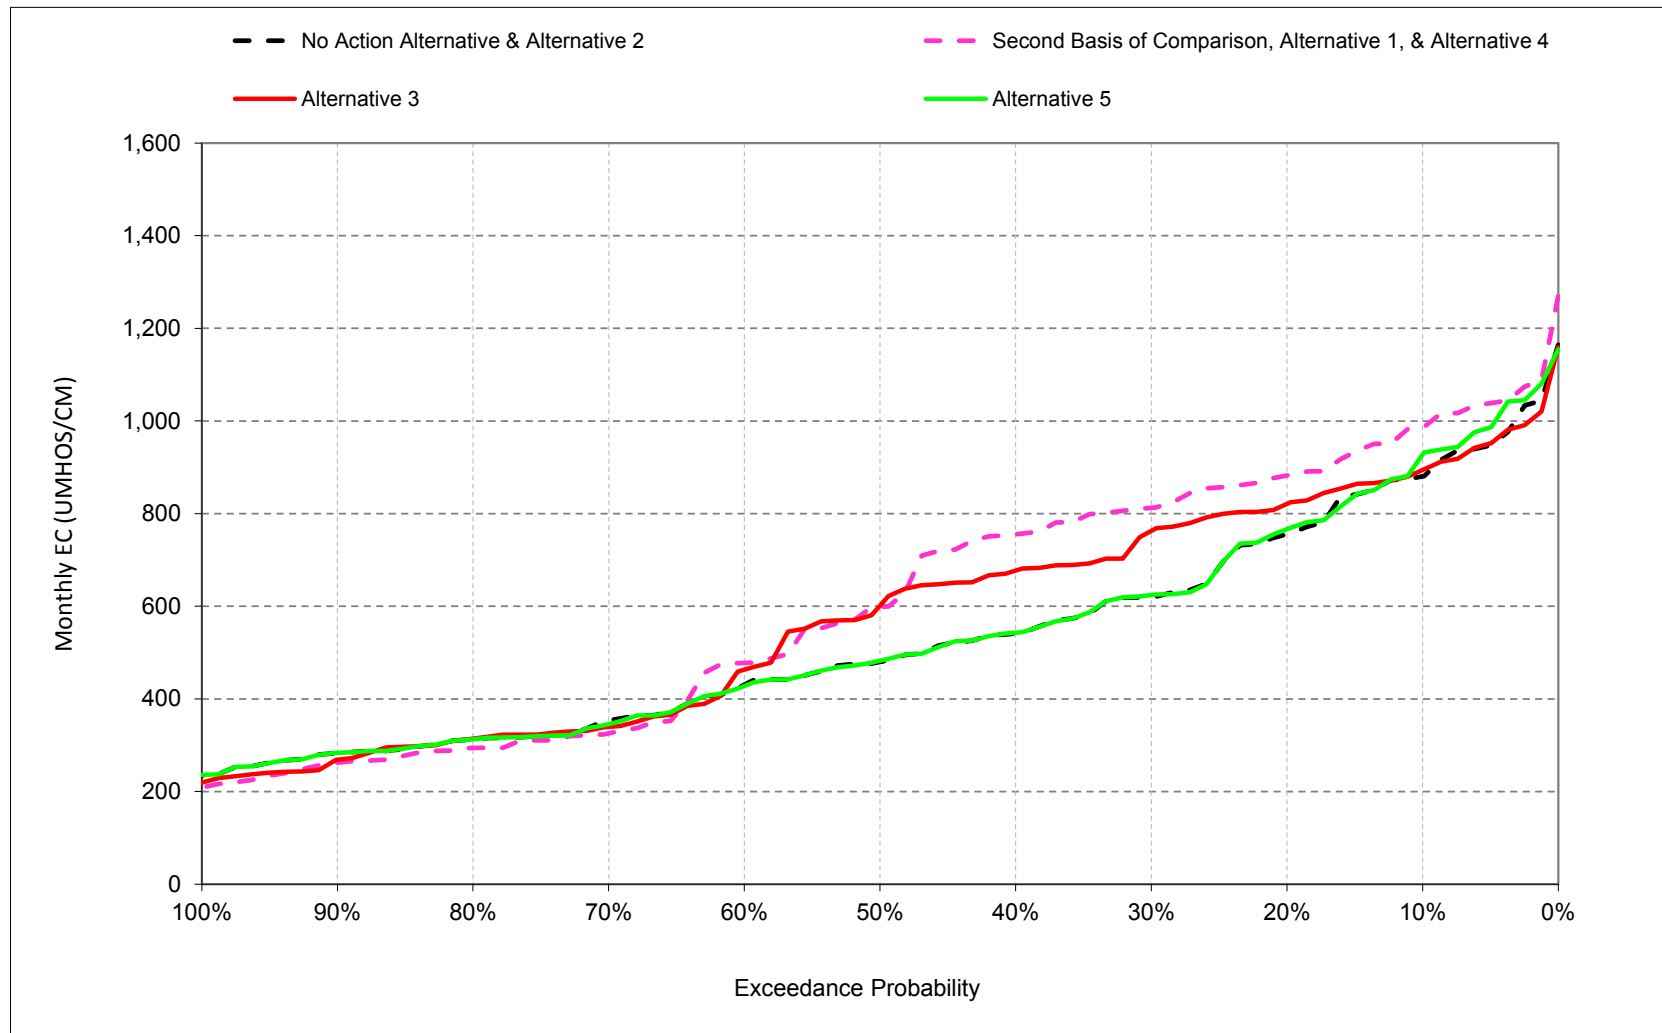


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.11.5. Old River at Rock Slough Salinity, Electrical Conductivity, February

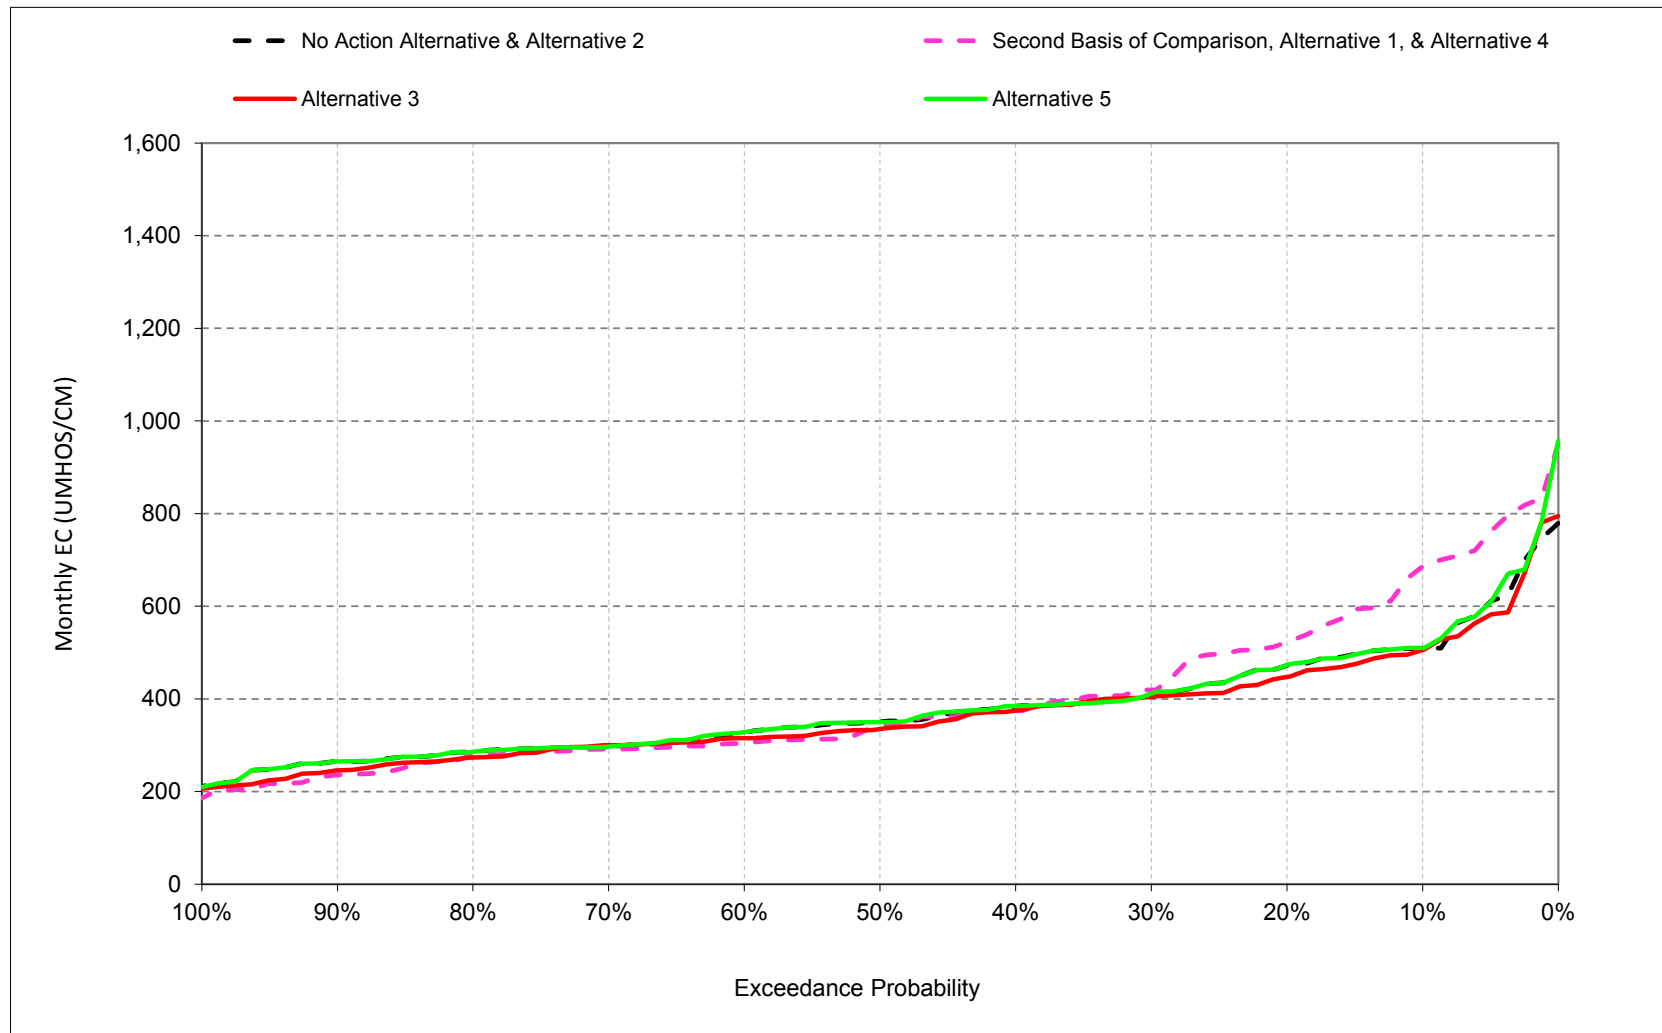


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.11.6. Old River at Rock Slough Salinity, Electrical Conductivity, March

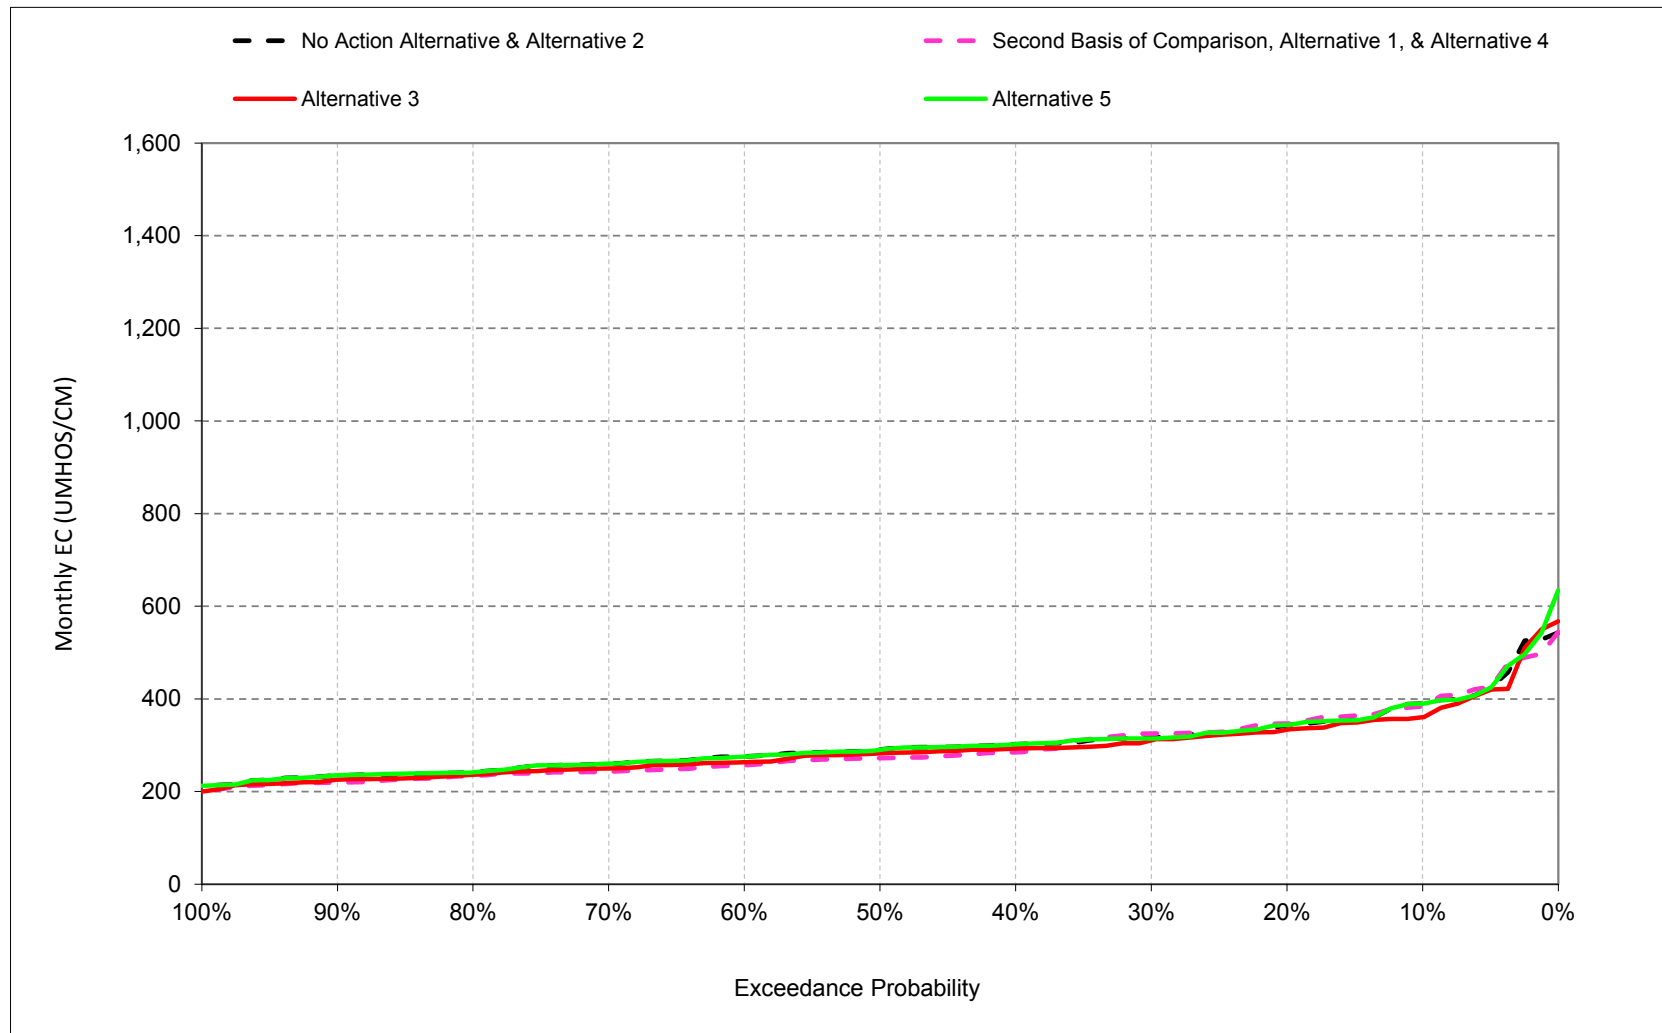


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.11.7. Old River at Rock Slough Salinity, Electrical Conductivity, April

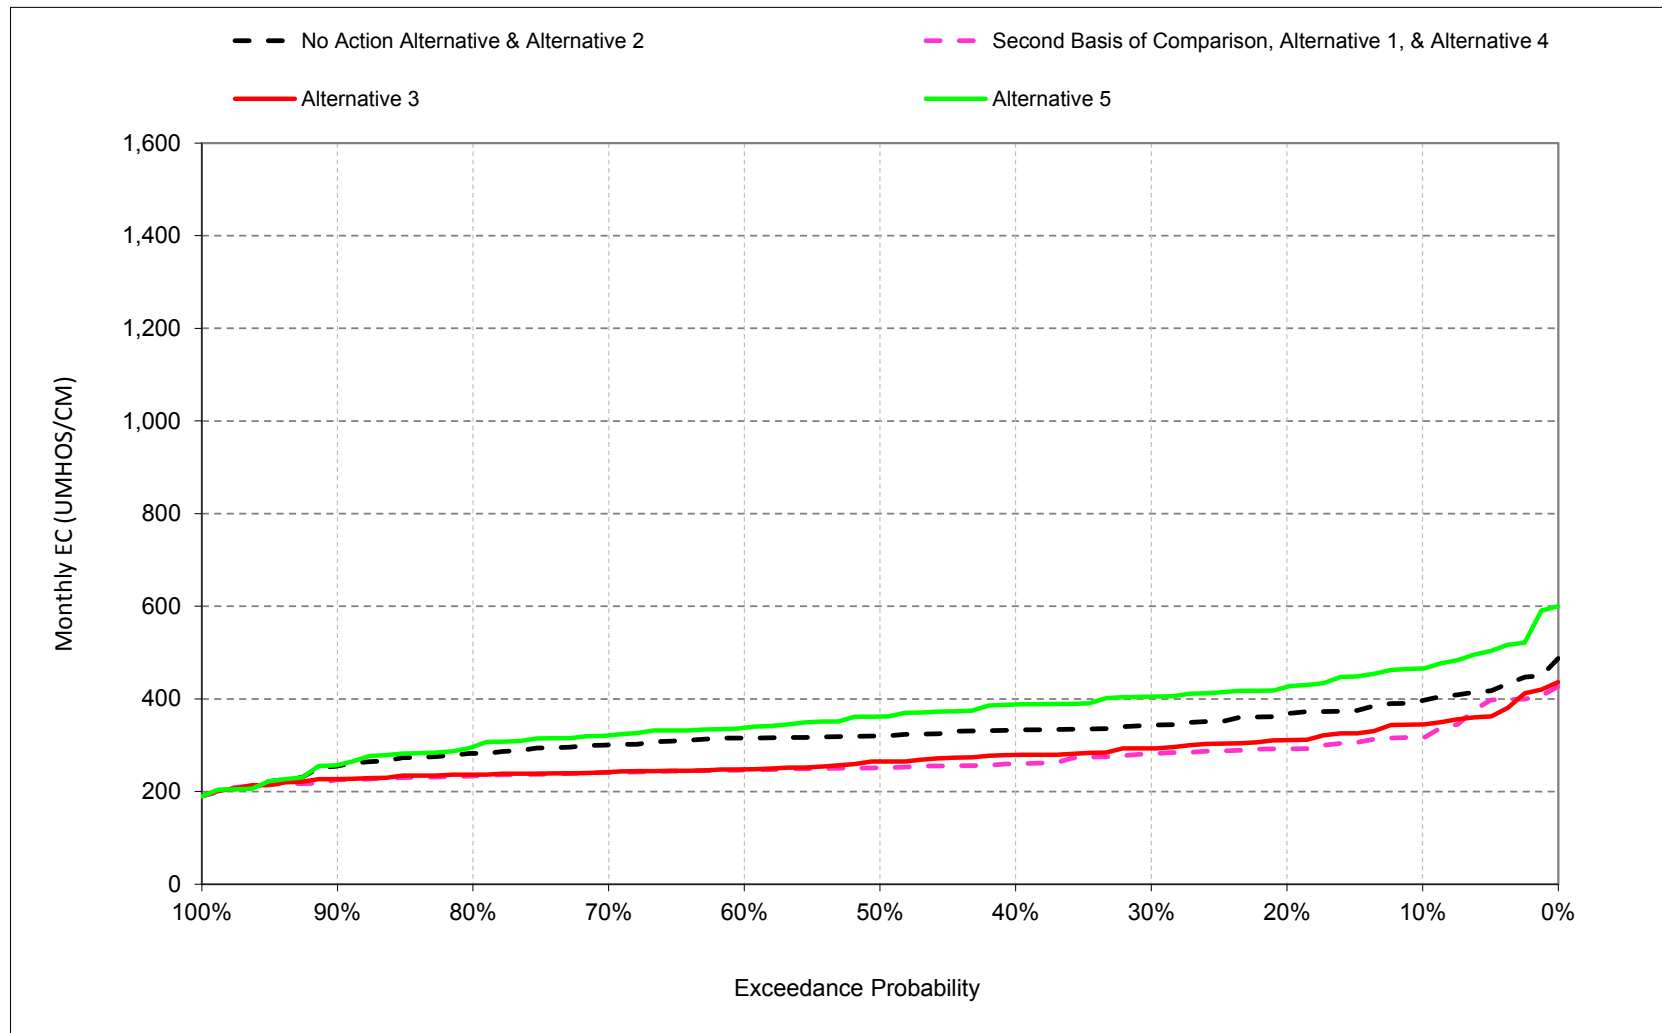


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.11.8. Old River at Rock Slough Salinity, Electrical Conductivity, May

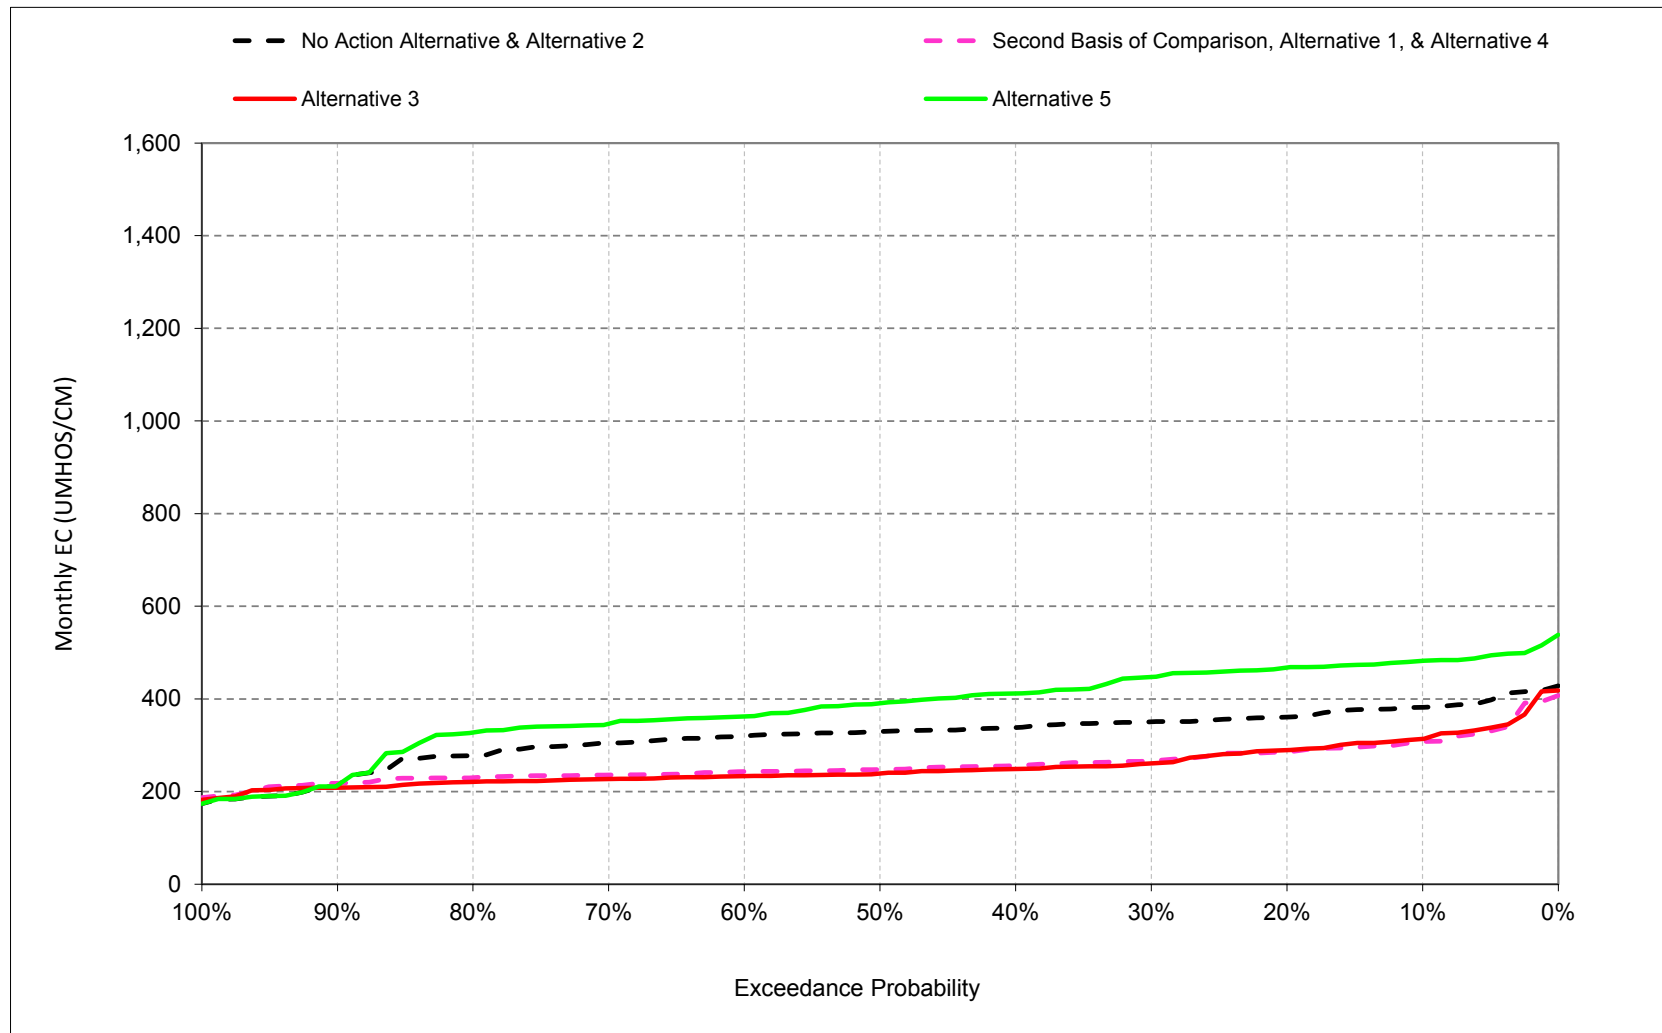


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.11.9. Old River at Rock Slough Salinity, Electrical Conductivity, June

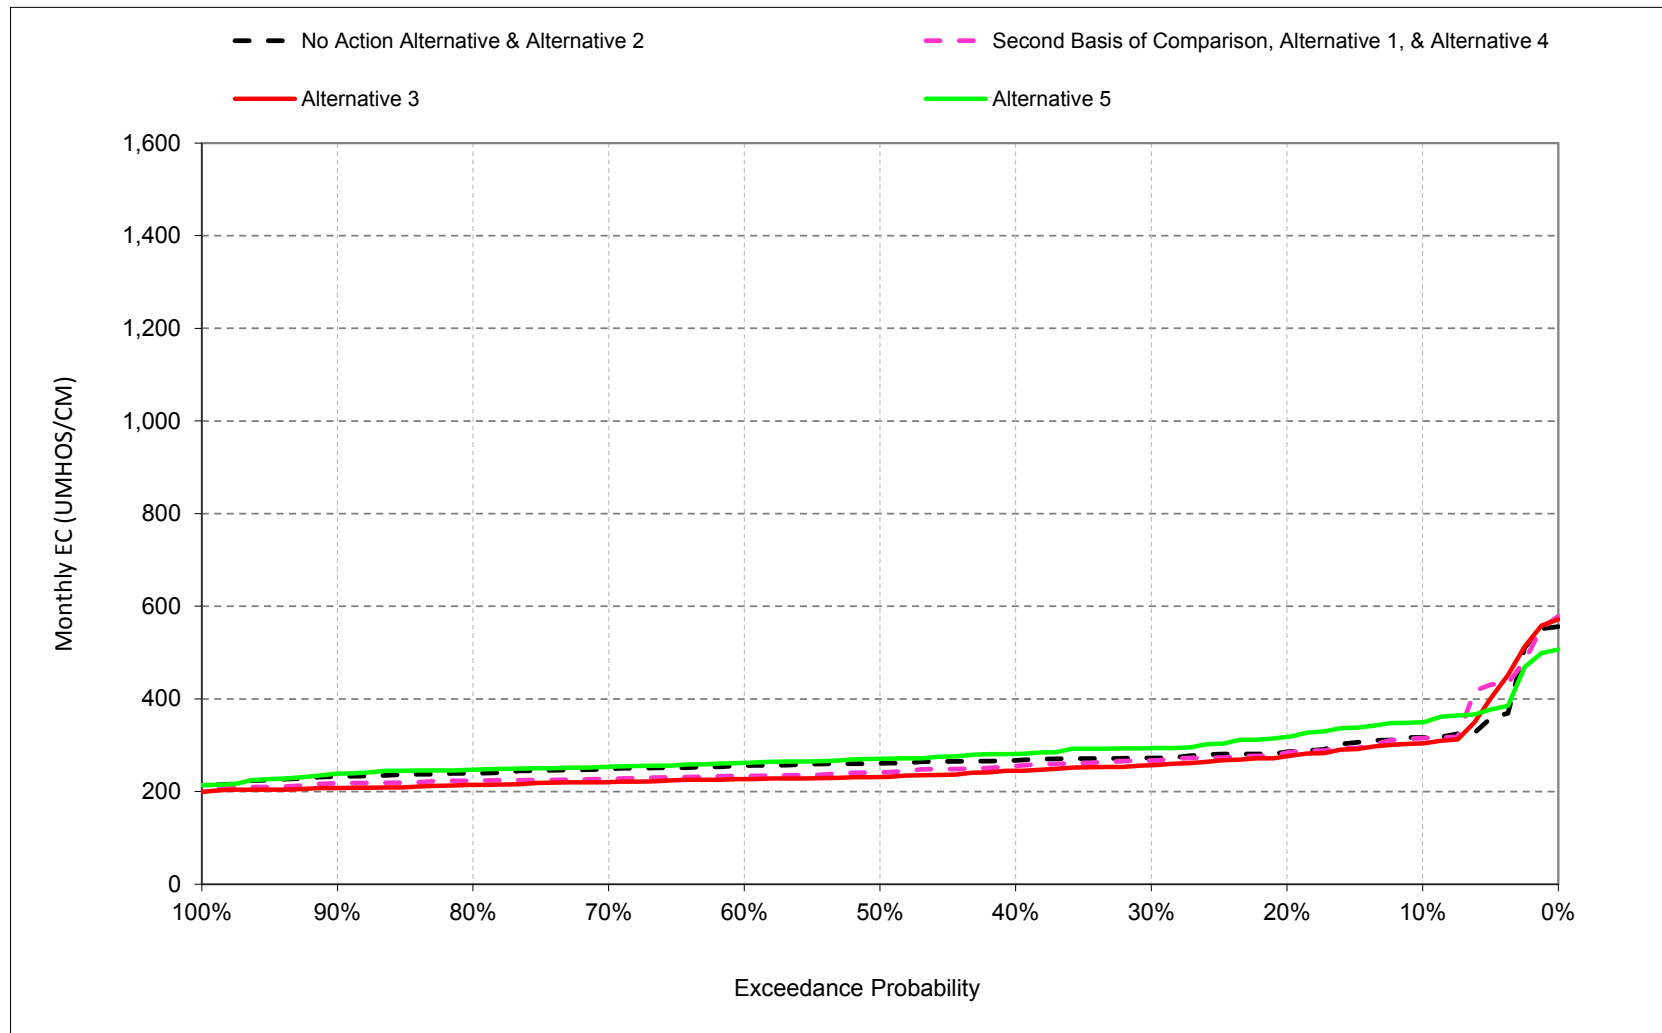


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.11.10. Old River at Rock Slough Salinity, Electrical Conductivity, July

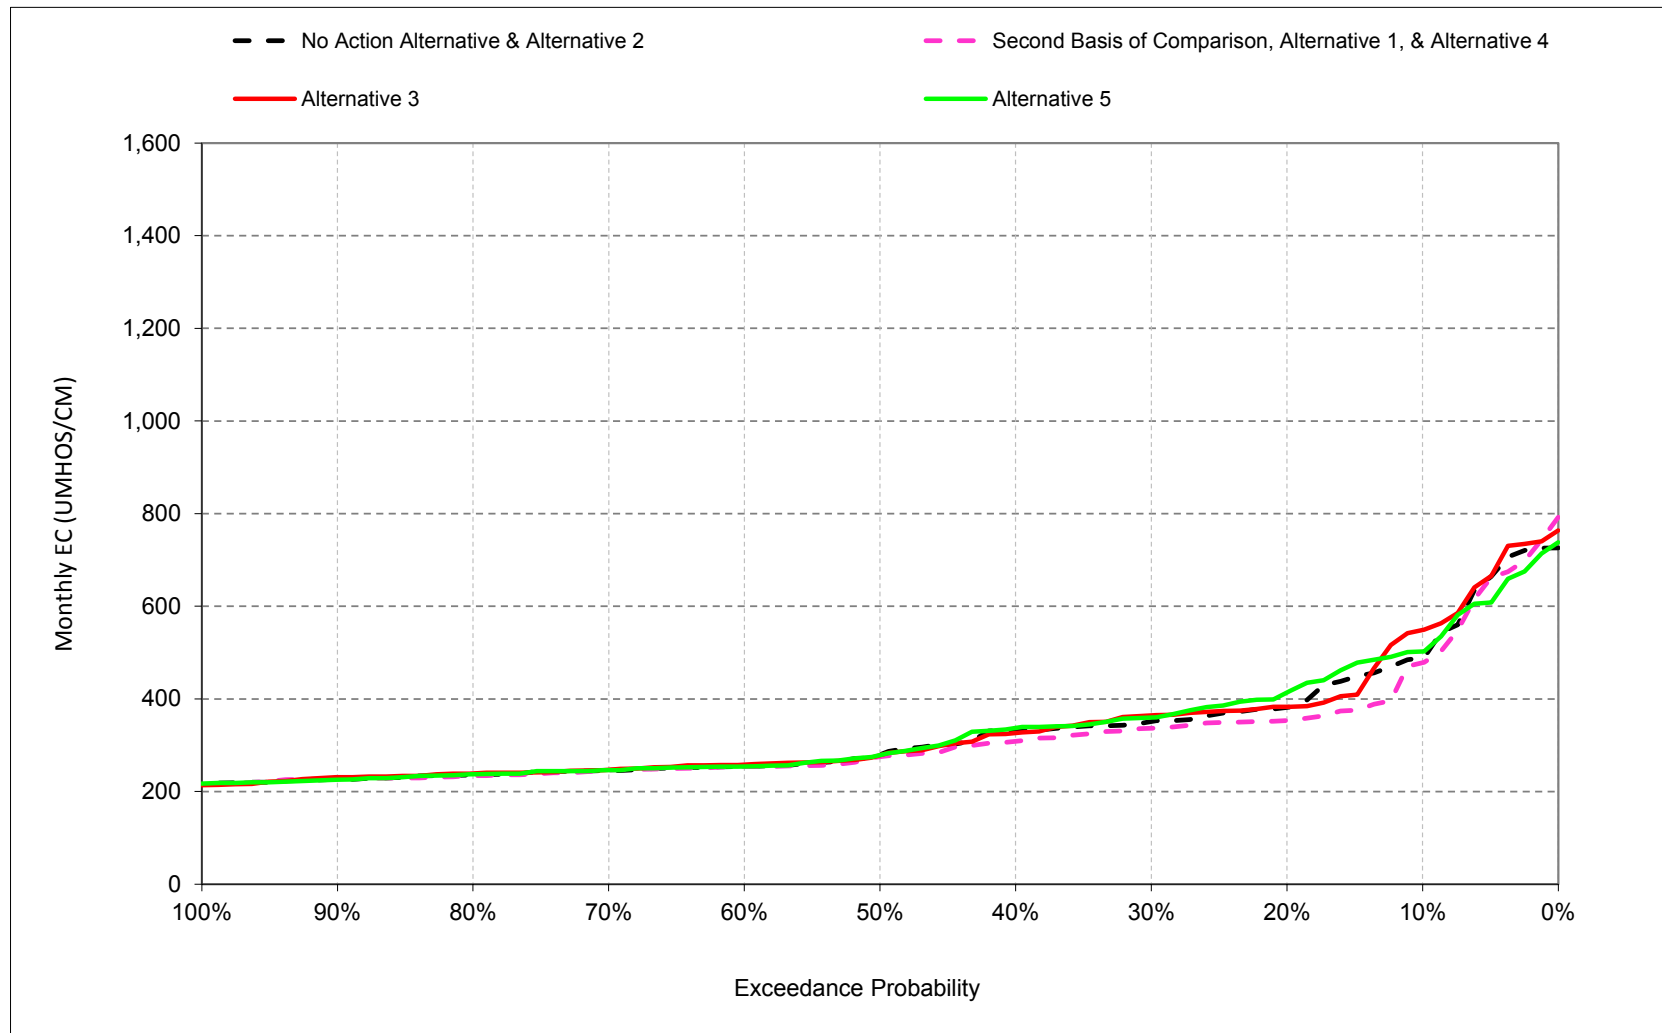


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.11.11. Old River at Rock Slough Salinity, Electrical Conductivity, August

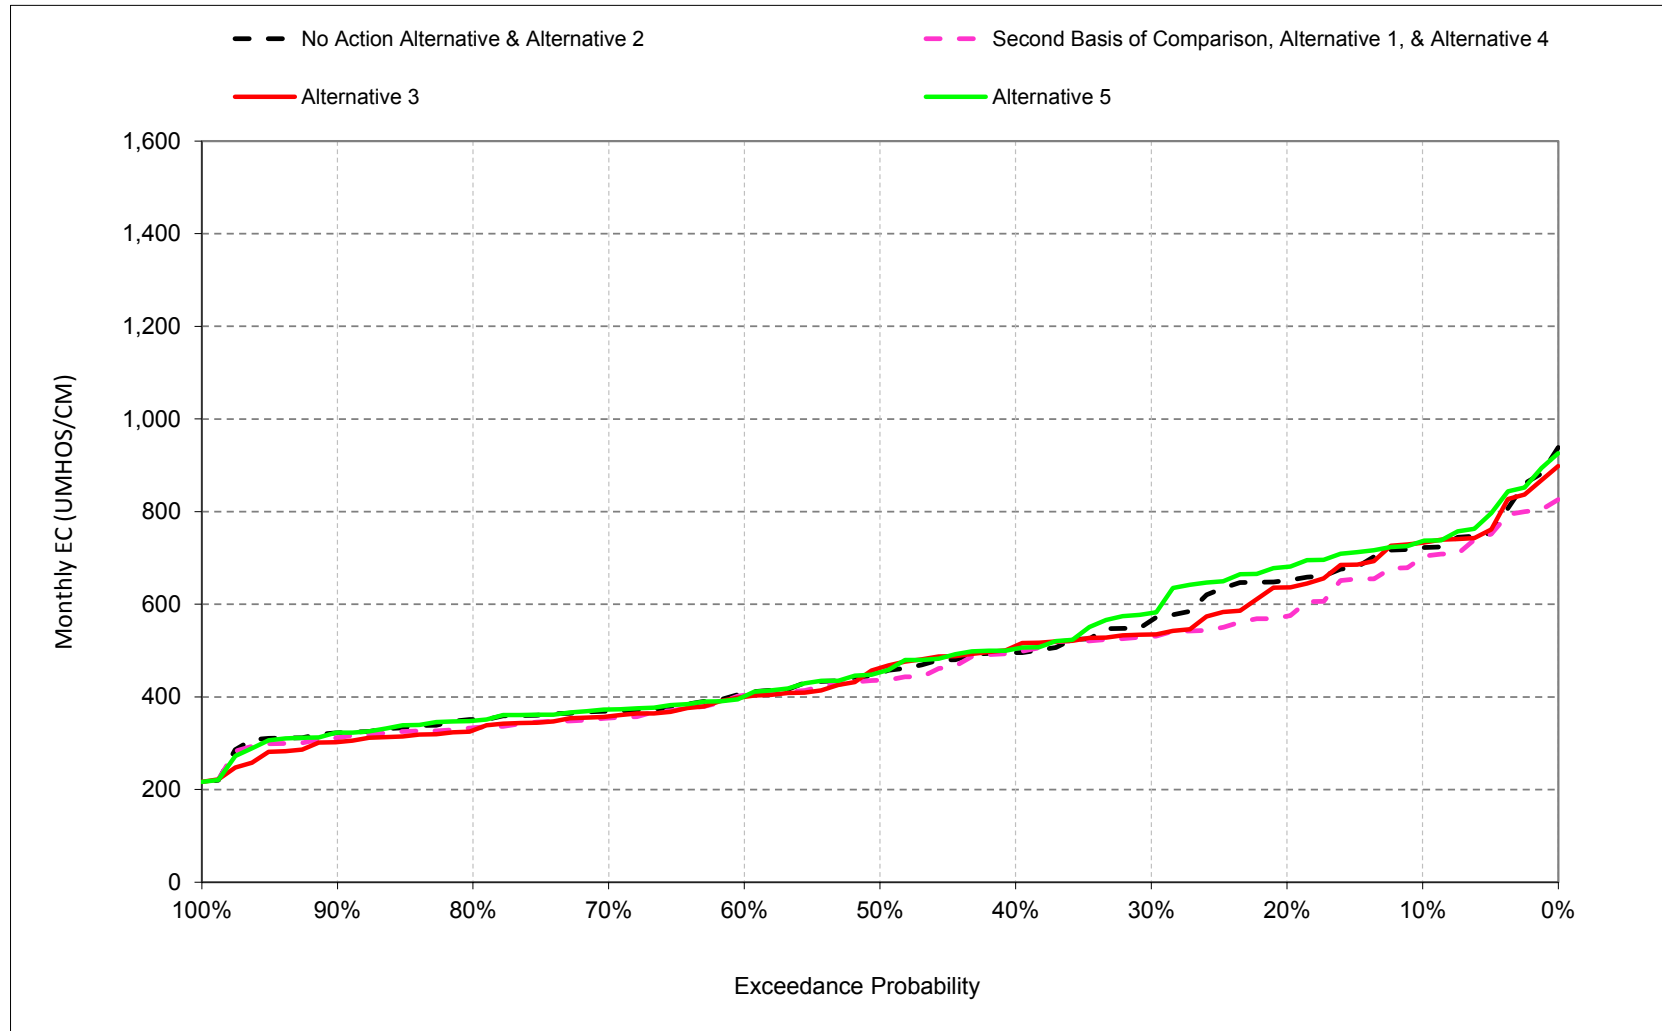

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.11.12. Old River at Rock Slough Salinity, Electrical Conductivity, September

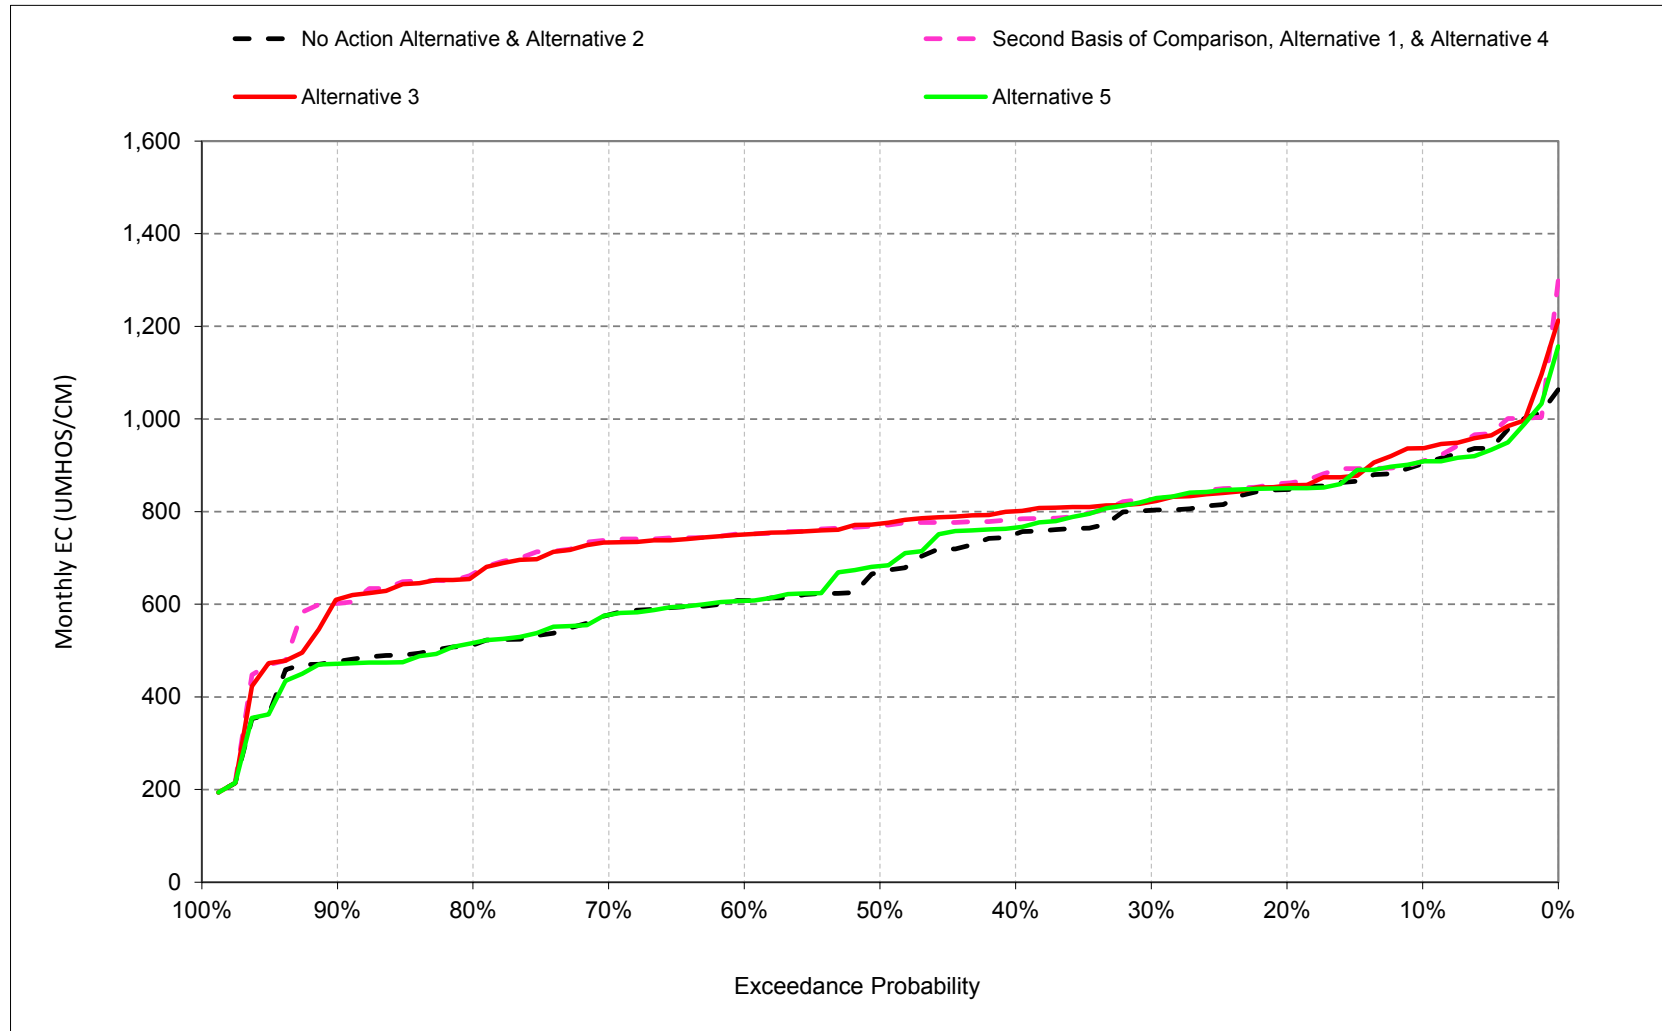

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.11.1. Old River at Rock Slough Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1,071	1,143	1,084	881	509	390	397	382	317	489	722	903
20%	993	919	971	756	472	343	368	361	286	382	651	848
30%	924	820	842	621	406	316	343	350	272	351	565	803
40%	866	767	599	541	384	302	333	338	268	332	496	752
50%	814	611	430	480	351	290	320	329	261	279	451	670
60%	290	306	351	430	327	276	315	320	256	254	407	608
70%	282	245	311	354	297	260	301	305	249	245	369	577
80%	274	234	271	312	286	242	282	278	239	236	351	512
90%	265	225	241	283	265	235	255	213	233	226	323	476
Long Term												
Full Simulation Period ^b	640	608	588	533	379	302	324	319	274	332	491	678
Water Year Types ^c												
Wet (32%)	503	444	378	353	321	277	281	281	244	236	346	535
Above Normal (16%)	797	731	593	475	342	271	338	347	255	248	376	490
Below Normal (13%)	503	467	539	537	374	291	351	355	270	319	475	811
Dry (24%)	646	642	677	657	403	310	330	314	267	407	624	781
Critical (15%)	884	901	933	778	508	386	366	349	379	521	725	897
Alternative 1												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1,080	1,141	1,161	987	686	384	317	308	316	478	702	909
20%	1,006	1,006	1,037	882	523	347	292	286	284	353	574	862
30%	963	931	1,016	813	420	325	282	266	267	337	531	826
40%	941	874	981	756	374	285	260	256	255	308	497	784
50%	913	847	870	599	340	272	251	248	241	275	436	770
60%	894	823	802	478	305	257	247	243	234	254	404	752
70%	863	784	696	326	292	243	241	236	227	246	354	741
80%	832	669	522	294	277	234	234	230	224	234	333	684
90%	751	492	286	262	236	220	225	218	218	228	312	608
Long Term												
Full Simulation Period ^b	895	835	819	610	399	294	268	259	265	321	469	764
Water Year Types ^c												
Wet (32%)	813	768	613	357	296	276	257	229	233	235	329	644
Above Normal (16%)	976	855	798	576	332	257	245	236	227	245	372	770
Below Normal (13%)	829	754	834	717	504	301	267	257	242	319	475	774
Dry (24%)	916	860	944	749	445	285	262	270	263	361	564	814
Critical (15%)	1,012	994	1,068	863	524	379	325	329	396	523	713	926
Alternative 1 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	9	-2	77	106	177	-6	-80	-74	-1	-11	-20	5
20%	13	86	65	127	50	4	-75	-75	-2	-29	-77	14
30%	40	111	174	192	14	9	-61	-84	-5	-14	-34	24
40%	76	108	382	215	-10	-17	-73	-82	-12	-24	1	32
50%	99	236	440	119	-10	-18	-69	-82	-20	-4	-15	100
60%	604	517	451	47	-22	-19	-69	-76	-22	-1	-3	144
70%	581	539	385	-28	-5	-17	-60	-69	-21	1	-15	164
80%	558	435	251	-18	-9	-8	-49	-48	-16	-2	-18	172
90%	486	267	45	-21	-29	-15	-30	5	-15	2	-11	132
Long Term												
Full Simulation Period ^b	255	228	231	77	20	-8	-56	-60	-10	-12	-22	87
Water Year Types ^c												
Wet (32%)	310	324	235	4	-25	-1	-24	-51	-11	-1	-16	109
Above Normal (16%)	179	125	205	101	-11	-14	-93	-111	-28	-3	-4	281
Below Normal (13%)	326	287	295	179	131	10	-84	-97	-29	-1	0	-36
Dry (24%)	270	218	267	93	42	-25	-68	-44	-3	-45	-60	33
Critical (15%)	128	93	135	85	16	-6	-40	-19	17	2	-13	29

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.11.2. Old River at Rock Slough Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1,071	1,143	1,084	881	509	390	397	382	317	489	722	903
20%	993	919	971	756	472	343	368	361	286	382	651	848
30%	924	820	842	621	406	316	343	350	272	351	565	803
40%	866	767	599	541	384	302	333	338	268	332	496	752
50%	814	611	430	480	351	290	320	329	261	279	451	670
60%	290	306	351	430	327	276	315	320	256	254	407	608
70%	282	245	311	354	297	260	301	305	249	245	369	577
80%	274	234	271	312	286	242	282	278	239	236	351	512
90%	265	225	241	283	265	235	255	213	233	226	323	476
Long Term												
Full Simulation Period ^b	640	608	588	533	379	302	324	319	274	332	491	678
Water Year Types ^c												
Wet (32%)	503	444	378	353	321	277	281	281	244	236	346	535
Above Normal (16%)	797	731	593	475	342	271	338	347	255	248	376	490
Below Normal (13%)	503	467	539	537	374	291	351	355	270	319	475	811
Dry (24%)	646	642	677	657	403	310	330	314	267	407	624	781
Critical (15%)	884	901	933	778	508	386	366	349	379	521	725	897

Alternative 3

Alternative 3												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1,075	1,125	1,158	894	505	360	345	314	304	549	733	937
20%	1,009	1,010	1,057	821	447	334	311	289	276	383	637	856
30%	974	932	1,002	763	405	310	293	261	257	365	535	823
40%	945	869	966	677	375	293	279	249	245	327	510	805
50%	907	842	862	601	335	282	265	239	231	278	462	779
60%	879	818	794	463	315	263	248	233	227	258	400	753
70%	846	790	677	339	300	250	242	227	220	247	358	734
80%	826	732	509	314	274	236	236	221	215	239	328	683
90%	769	545	298	268	245	226	227	209	208	231	303	620
Long Term												
Full Simulation Period ^b	896	850	808	576	367	293	276	254	256	337	480	765
Water Year Types ^c												
Wet (32%)	806	782	613	376	305	269	252	220	220	237	324	627
Above Normal (16%)	999	892	791	557	326	258	249	229	221	252	372	776
Below Normal (13%)	833	742	836	656	387	280	276	260	245	344	496	826
Dry (24%)	907	885	943	702	392	301	284	262	254	403	600	805
Critical (15%)	1,015	993	998	750	489	381	342	334	387	527	721	926

Alternative 3 minus No Action Alternative

Alternative 3 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	5	-18	74	13	-4	-30	-52	-68	-13	60	11	33
20%	16	90	85	66	-25	-9	-57	-72	-10	1	-15	8
30%	50	112	160	142	-1	-6	-50	-90	-16	14	-30	20
40%	80	103	367	136	-9	-9	-54	-89	-23	-6	14	54
50%	93	231	432	121	-16	-8	-55	-90	-30	-1	11	109
60%	588	512	443	33	-12	-12	-67	-86	-29	4	-7	145
70%	564	545	366	-14	3	-11	-59	-78	-29	2	-11	157
80%	552	498	238	2	-12	-5	-46	-57	-24	4	-23	170
90%	504	320	57	-15	-20	-10	-29	-5	-25	5	-20	144
Long Term												
Full Simulation Period ^b	255	242	220	43	-11	-9	-48	-65	-18	4	-11	87
Water Year Types ^c												
Wet (32%)	303	337	236	23	-16	-8	-29	-61	-24	2	-22	92
Above Normal (16%)	203	162	198	82	-16	-14	-89	-117	-34	3	-4	286
Below Normal (13%)	330	275	297	119	13	-11	-75	-94	-25	24	21	16
Dry (24%)	262	243	266	45	-11	-9	-46	-51	-13	-4	-24	25
Critical (15%)	131	92	65	-28	-20	-4	-24	-15	8	6	-4	29

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.11.3. Old River at Rock Slough Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1,071	1,143	1,084	881	509	390	397	382	317	489	722	903
20%	993	919	971	756	472	343	368	361	286	382	651	848
30%	924	820	842	621	406	316	343	350	272	351	565	803
40%	866	767	599	541	384	302	333	338	268	332	496	752
50%	814	611	430	480	351	290	320	329	261	279	451	670
60%	290	306	351	430	327	276	315	320	256	254	407	608
70%	282	245	311	354	297	260	301	305	249	245	369	577
80%	274	234	271	312	286	242	282	278	239	236	351	512
90%	265	225	241	283	265	235	255	213	233	226	323	476
Long Term												
Full Simulation Period ^b	640	608	588	533	379	302	324	319	274	332	491	678
Water Year Types ^c												
Wet (32%)	503	444	378	353	321	277	281	281	244	236	346	535
Above Normal (16%)	797	731	593	475	342	271	338	347	255	248	376	490
Below Normal (13%)	503	467	539	537	374	291	351	355	270	319	475	811
Dry (24%)	646	642	677	657	403	310	330	314	267	407	624	781
Critical (15%)	884	901	933	778	508	386	366	349	379	521	725	897

Alternative 5												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1,106	1,138	1,079	927	510	390	466	482	350	503	736	908
20%	996	963	949	766	473	344	426	468	318	414	681	850
30%	934	832	846	624	411	315	405	447	294	360	581	826
40%	889	759	650	543	385	302	388	412	281	337	504	766
50%	800	621	412	482	350	290	362	391	271	279	453	682
60%	291	305	350	428	328	276	338	362	262	254	401	608
70%	281	244	312	345	297	260	321	346	253	246	373	577
80%	275	233	270	312	286	242	296	327	247	238	348	517
90%	267	225	241	283	265	235	257	213	239	225	323	471
Long Term												
Full Simulation Period ^b	645	609	588	536	383	303	364	380	287	336	500	686
Water Year Types ^c												
Wet (32%)	504	454	384	353	323	278	282	285	246	236	345	532
Above Normal (16%)	812	724	583	473	342	271	342	361	260	249	374	488
Below Normal (13%)	502	470	538	537	373	290	381	411	286	324	476	820
Dry (24%)	651	637	675	668	406	311	413	440	296	426	656	803
Critical (15%)	886	900	932	783	525	393	472	480	387	506	734	914

Alternative 5 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	35	-5	-5	46	1	0	69	101	33	14	14	5
20%	3	44	-22	11	1	1	58	107	32	32	29	3
30%	10	12	4	4	6	-1	62	97	21	9	16	24
40%	24	-8	51	2	1	0	55	74	14	5	8	14
50%	-13	10	-18	2	-1	0	42	61	10	-1	2	12
60%	1	-1	-2	-2	1	0	22	43	6	0	-6	0
70%	-1	-1	2	-8	0	0	20	41	5	1	3	0
80%	1	0	0	0	0	0	14	50	8	2	-3	4
90%	2	0	0	0	0	0	2	0	6	-1	0	-5
Long Term												
Full Simulation Period ^b	4	1	0	3	4	1	41	61	12	3	9	8
Water Year Types ^c												
Wet (32%)	1	10	6	0	2	1	1	5	2	0	0	-3
Above Normal (16%)	15	-6	-10	-2	0	0	4	14	6	1	-1	-1
Below Normal (13%)	-1	3	-1	-1	-1	-1	30	56	16	4	1	9
Dry (24%)	6	-5	-2	12	3	1	83	126	29	19	32	23
Critical (15%)	3	-1	-1	5	17	8	106	132	8	-15	9	17

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.11.4. Old River at Rock Slough Salinity, Monthly EC

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	1,080	1,141	1,161	987	686	384	317	308	316	478	702	909
20%	1,006	1,006	1,037	882	523	347	292	286	284	353	574	862
30%	963	931	1,016	813	420	325	282	266	267	337	531	826
40%	941	874	981	756	374	285	260	256	255	308	497	784
50%	913	847	870	599	340	272	251	248	241	275	436	770
60%	894	823	802	478	305	257	247	243	234	254	404	752
70%	863	784	696	326	292	243	241	236	227	246	354	741
80%	832	669	522	294	277	234	234	230	224	234	333	684
90%	751	492	286	262	236	220	225	218	218	228	312	608
Long Term												
Full Simulation Period ^b	895	835	819	610	399	294	268	259	265	321	469	764
Water Year Types ^c												
Wet (32%)	813	768	613	357	296	276	257	229	233	235	329	644
Above Normal (16%)	976	855	798	576	332	257	245	236	227	245	372	770
Below Normal (13%)	829	754	834	717	504	301	267	257	242	319	475	774
Dry (24%)	916	860	944	749	445	285	262	270	263	361	564	814
Critical (15%)	1,012	994	1,068	863	524	379	325	329	396	523	713	926

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance ^a												
10%	1,071	1,143	1,084	881	509	390	397	382	317	489	722	903
20%	993	919	971	756	472	343	368	361	286	382	651	848
30%	924	820	842	621	406	316	343	350	272	351	565	803
40%	866	767	599	541	384	302	333	338	268	332	496	752
50%	814	611	430	480	351	290	320	329	261	279	451	670
60%	290	306	351	430	327	276	315	320	256	254	407	608
70%	282	245	311	354	297	260	301	305	249	245	369	577
80%	274	234	271	312	286	242	282	278	239	236	351	512
90%	265	225	241	283	265	235	255	213	233	226	323	476
Long Term												
Full Simulation Period ^b	640	608	588	533	379	302	324	319	274	332	491	678
Water Year Types ^c												
Wet (32%)	503	444	378	353	321	277	281	281	244	236	346	535
Above Normal (16%)	797	731	593	475	342	271	338	347	255	248	376	490
Below Normal (13%)	503	467	539	537	374	291	351	355	270	319	475	811
Dry (24%)	646	642	677	657	403	310	330	314	267	407	624	781
Critical (15%)	884	901	933	778	508	386	366	349	379	521	725	897

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative minus Second Basis of Comparison												
Probability of Exceedance ^a												
10%	-9	2	-77	-106	-177	6	80	74	1	11	20	-5
20%	-13	-86	-65	-127	-50	-4	75	75	2	29	77	-14
30%	-40	-111	-174	-192	-14	-9	61	84	5	14	34	-24
40%	-76	-108	-382	-215	10	17	73	82	12	24	-1	-32
50%	-99	-236	-440	-119	10	18	69	82	20	4	15	-100
60%	-604	-517	-451	-47	22	19	69	76	22	1	3	-144
70%	-581	-539	-385	28	5	17	60	69	21	-1	15	-164
80%	-558	-435	-251	18	9	8	49	48	16	2	18	-172
90%	-486	-267	-45	21	29	15	30	-5	15	-2	11	-132
Long Term												
Full Simulation Period ^b	-255	-228	-231	-77	-20	8	56	60	10	12	22	-87
Water Year Types ^c												
Wet (32%)	-310	-324	-235	-4	25	1	24	51	11	1	16	-109
Above Normal (16%)	-179	-125	-205	-101	11	14	93	111	28	3	4	-281
Below Normal (13%)	-326	-287	-295	-179	-131	-10	84	97	29	1	0	36
Dry (24%)	-270	-218	-267	-93	-42	25	68	44	3	45	60	-33
Critical (15%)	-128	-93	-135	-85	-16	6	40	19	-17	-2	13	-29

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.11.5. Old River at Rock Slough Salinity, Monthly EC

Second Basis of Comparison		Monthly EC (UMHOS/CM)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
10%	1,080	1,141	1,161	987	686	384	317	308	316	478	702	909	
20%	1,006	1,006	1,037	882	523	347	292	286	284	353	574	862	
30%	963	931	1,016	813	420	325	282	266	267	337	531	826	
40%	941	874	981	756	374	285	260	256	255	308	497	784	
50%	913	847	870	599	340	272	251	248	241	275	436	770	
60%	894	823	802	478	305	257	247	243	234	254	404	752	
70%	863	784	696	326	292	243	241	236	227	246	354	741	
80%	832	669	522	294	277	234	234	230	224	234	333	684	
90%	751	492	286	262	236	220	225	218	218	228	312	608	
Long Term													
Full Simulation Period ^b	895	835	819	610	399	294	268	259	265	321	469	764	
Water Year Types ^c													
Wet (32%)	813	768	613	357	296	276	257	229	233	235	329	644	
Above Normal (16%)	976	855	798	576	332	257	245	236	227	245	372	770	
Below Normal (13%)	829	754	834	717	504	301	267	257	242	319	475	774	
Dry (24%)	916	860	944	749	445	285	262	270	263	361	564	814	
Critical (15%)	1,012	994	1,068	863	524	379	325	329	396	523	713	926	

Alternative 3

Alternative 3		Monthly EC (UMHOS/CM)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
10%	1,075	1,125	1,158	894	505	360	345	314	304	549	733	937	
20%	1,009	1,010	1,057	821	447	334	311	289	276	383	637	856	
30%	974	932	1,002	763	405	310	293	261	257	365	535	823	
40%	945	869	966	677	375	293	279	249	245	327	510	805	
50%	907	842	862	601	335	282	265	239	231	278	462	779	
60%	879	818	794	463	315	263	248	233	227	258	400	753	
70%	846	790	677	339	300	250	242	227	220	247	358	734	
80%	826	732	509	314	274	236	236	221	215	239	328	683	
90%	769	545	298	268	245	226	227	209	208	231	303	620	
Long Term													
Full Simulation Period ^b	896	850	808	576	367	293	276	254	256	337	480	765	
Water Year Types ^c													
Wet (32%)	806	782	613	376	305	269	252	220	220	237	324	627	
Above Normal (16%)	999	892	791	557	326	258	249	229	221	252	372	776	
Below Normal (13%)	833	742	836	656	387	280	276	260	245	344	496	826	
Dry (24%)	907	885	943	702	392	301	284	262	254	403	600	805	
Critical (15%)	1,015	993	998	750	489	381	342	334	387	527	721	926	

Alternative 3 minus Second Basis of Comparison

Alternative 3 minus Second Basis of Comparison		Monthly EC (UMHOS/CM)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
10%	-4	-16	-3	-93	-181	-24	28	6	-11	71	31	28	
20%	3	4	20	-61	-75	-13	19	4	-8	30	62	-5	
30%	10	1	-15	-50	-15	-15	12	-6	-10	28	4	-4	
40%	4	-5	-15	-79	1	8	19	-7	-11	18	13	22	
50%	-6	-5	-8	2	-5	10	14	-9	-10	3	26	9	
60%	-16	-6	-8	-14	10	7	1	-10	-7	4	-3	1	
70%	-18	6	-19	14	8	7	1	-9	-7	1	4	-7	
80%	-6	63	-13	20	-3	3	3	-9	-9	5	-6	-2	
90%	18	53	12	6	10	6	2	-9	-10	3	-9	12	
Long Term													
Full Simulation Period ^b	0	14	-11	-34	-32	-1	8	-5	-8	16	11	0	
Water Year Types ^c													
Wet (32%)	-7	13	1	18	9	-7	-5	-9	-13	2	-6	-17	
Above Normal (16%)	23	37	-7	-20	-5	1	4	-6	-6	6	0	6	
Below Normal (13%)	4	-12	2	-61	-118	-21	9	3	3	25	21	52	
Dry (24%)	-8	25	-1	-48	-53	16	22	-8	-10	41	36	-9	
Critical (15%)	3	-1	-70	-113	-35	2	17	4	-9	4	8	0	

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.11.6. Old River at Rock Slough Salinity, Monthly EC

Second Basis of Comparison		Monthly EC (UMHOS/CM)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	1,080	1,141	1,161	987	686	384	317	308	316	478	702	909	
20%	1,006	1,006	1,037	882	523	347	292	286	284	353	574	862	
30%	963	931	1,016	813	420	325	282	266	267	337	531	826	
40%	941	874	981	756	374	285	260	256	255	308	497	784	
50%	913	847	870	599	340	272	251	248	241	275	436	770	
60%	894	823	802	478	305	257	247	243	234	254	404	752	
70%	863	784	696	326	292	243	241	236	227	246	354	741	
80%	832	669	522	294	277	234	234	230	224	234	333	684	
90%	751	492	286	262	236	220	225	218	218	228	312	608	
Long Term													
Full Simulation Period ^b	895	835	819	610	399	294	268	259	265	321	469	764	
Water Year Types^c													
Wet (32%)	813	768	613	357	296	276	257	229	233	235	329	644	
Above Normal (16%)	976	855	798	576	332	257	245	236	227	245	372	770	
Below Normal (13%)	829	754	834	717	504	301	267	257	242	319	475	774	
Dry (24%)	916	860	944	749	445	285	262	270	263	361	564	814	
Critical (15%)	1,012	994	1,068	863	524	379	325	329	396	523	713	926	

Alternative 5

Alternative 5		Monthly EC (UMHOS/CM)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	1,106	1,138	1,079	927	510	390	466	482	350	503	736	908	
20%	996	963	949	766	473	344	426	468	318	414	681	850	
30%	934	832	846	624	411	315	405	447	294	360	581	826	
40%	889	759	650	543	385	302	388	412	281	337	504	766	
50%	800	621	412	482	350	290	362	391	271	279	453	682	
60%	291	305	350	428	328	276	338	362	262	254	401	608	
70%	281	244	312	345	297	260	321	346	253	246	373	577	
80%	275	233	270	312	286	242	296	327	247	238	348	517	
90%	267	225	241	283	265	235	257	213	239	225	323	471	
Long Term													
Full Simulation Period ^b	645	609	588	536	383	303	364	380	287	336	500	686	
Water Year Types^c													
Wet (32%)	504	454	384	353	323	278	282	285	246	236	345	532	
Above Normal (16%)	812	724	583	473	342	271	342	361	260	249	374	488	
Below Normal (13%)	502	470	538	537	373	290	381	411	286	324	476	820	
Dry (24%)	651	637	675	668	406	311	413	440	296	426	656	803	
Critical (15%)	886	900	932	783	525	393	472	480	387	506	734	914	

Alternative 5 minus Second Basis of Comparison

Alternative 5 minus Second Basis of Comparison		Monthly EC (UMHOS/CM)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	26	-3	-82	-60	-176	6	149	175	34	24	34	-1	
20%	-10	-42	-88	-116	-50	-3	134	182	34	61	106	-11	
30%	-30	-99	-170	-188	-8	-10	123	181	27	23	50	0	
40%	-52	-115	-331	-213	11	18	128	156	26	29	7	-18	
50%	-113	-226	-458	-117	9	18	111	143	29	3	17	-88	
60%	-603	-519	-452	-50	23	19	91	119	28	0	-3	-144	
70%	-582	-540	-384	20	5	17	80	110	26	0	18	-164	
80%	-558	-436	-252	18	9	8	63	97	24	3	15	-168	
90%	-484	-267	-45	21	29	15	32	-4	21	-3	11	-137	
Long Term													
Full Simulation Period ^b	-251	-227	-232	-73	-17	10	97	122	22	15	31	-79	
Water Year Types^c													
Wet (32%)	-309	-314	-229	-4	27	2	25	56	13	1	16	-112	
Above Normal (16%)	-164	-131	-214	-103	11	14	98	125	34	4	2	-282	
Below Normal (13%)	-327	-283	-295	-180	-132	-11	114	153	45	5	2	45	
Dry (24%)	-264	-223	-269	-81	-39	25	151	170	32	65	92	-10	
Critical (15%)	-126	-94	-136	-80	2	14	147	151	-9	-17	21	-12	

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.


^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.


1 **B.12 Contra Costa Water District Old River Intake Salinity**

Figure 6E.B.12.1. Contra Costa Water District Old River Intake Salinity, Electrical Conductivity, October

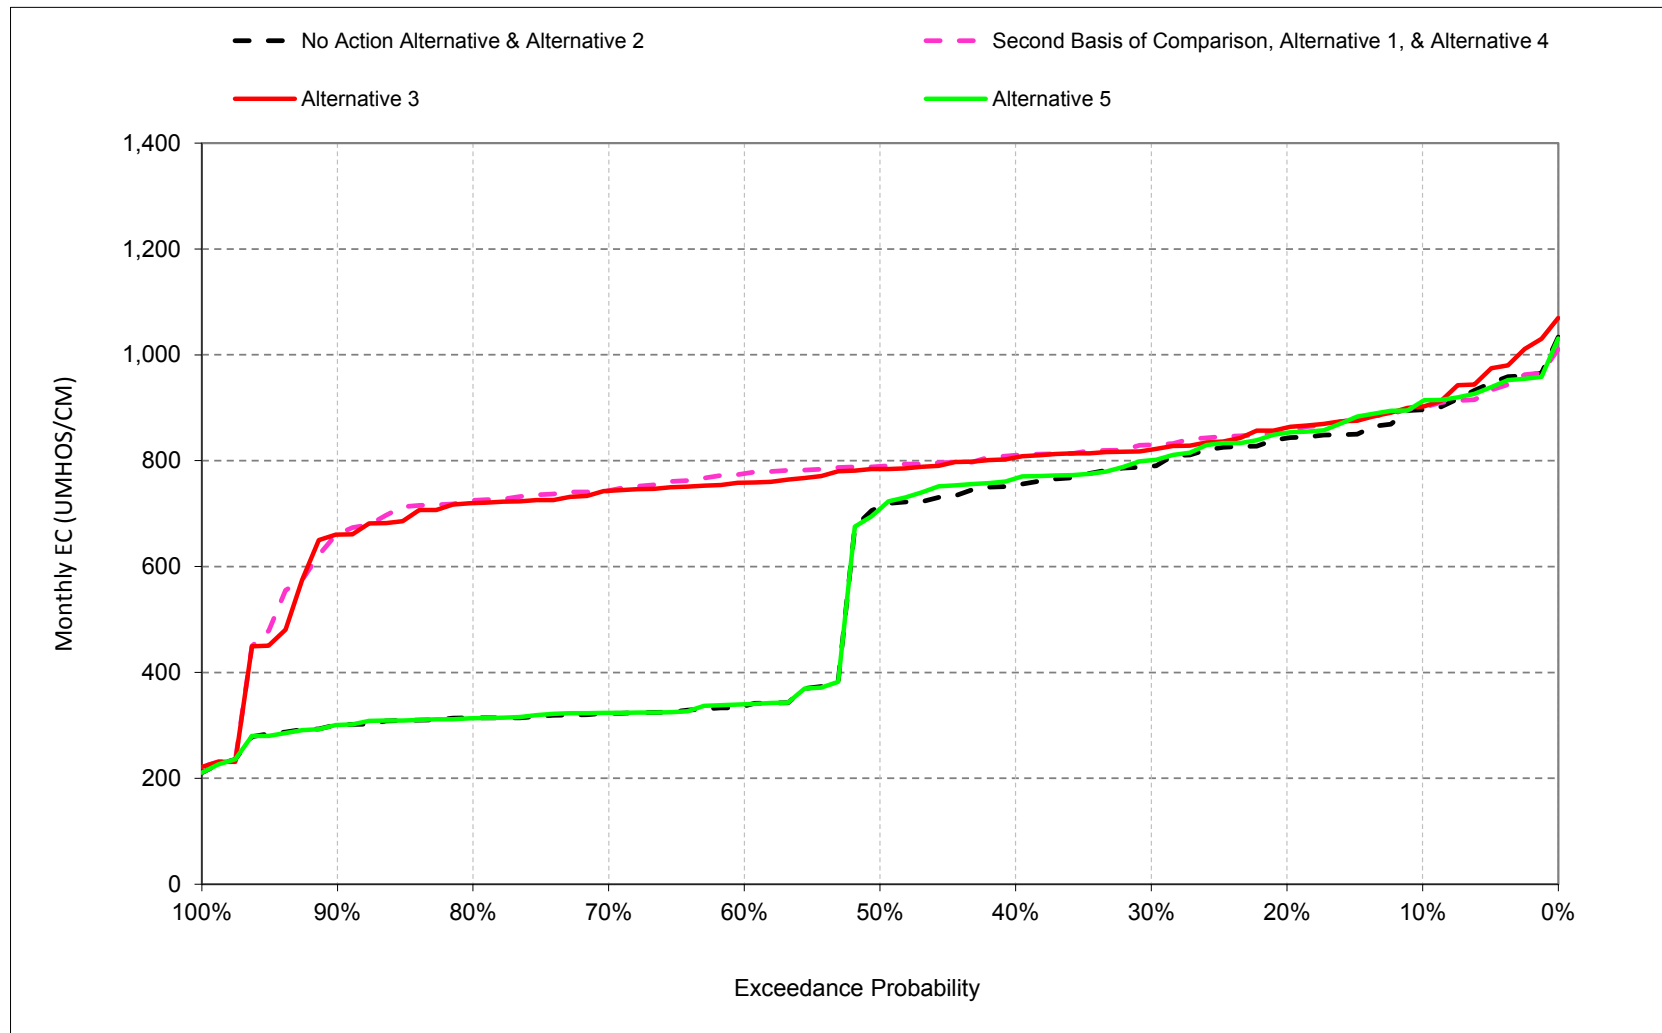


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.12.2. Contra Costa Water District Old River Intake Salinity, Electrical Conductivity, November

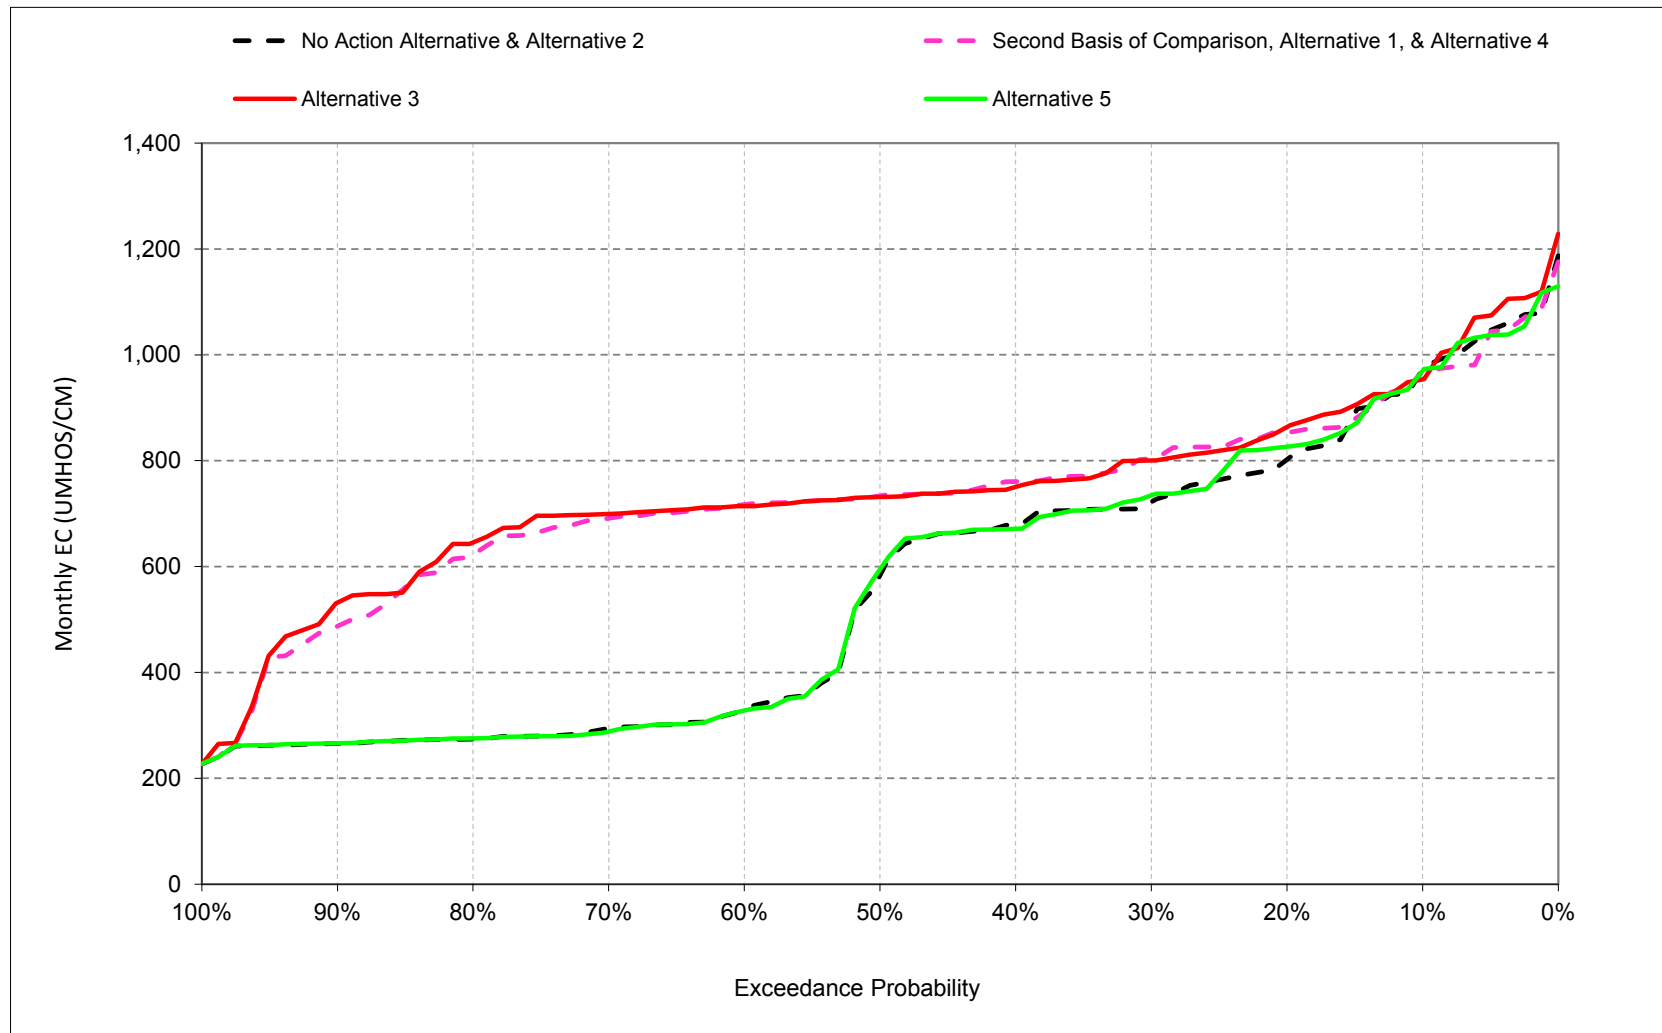


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.12.3. Contra Costa Water District Old River Intake Salinity, Electrical Conductivity, December

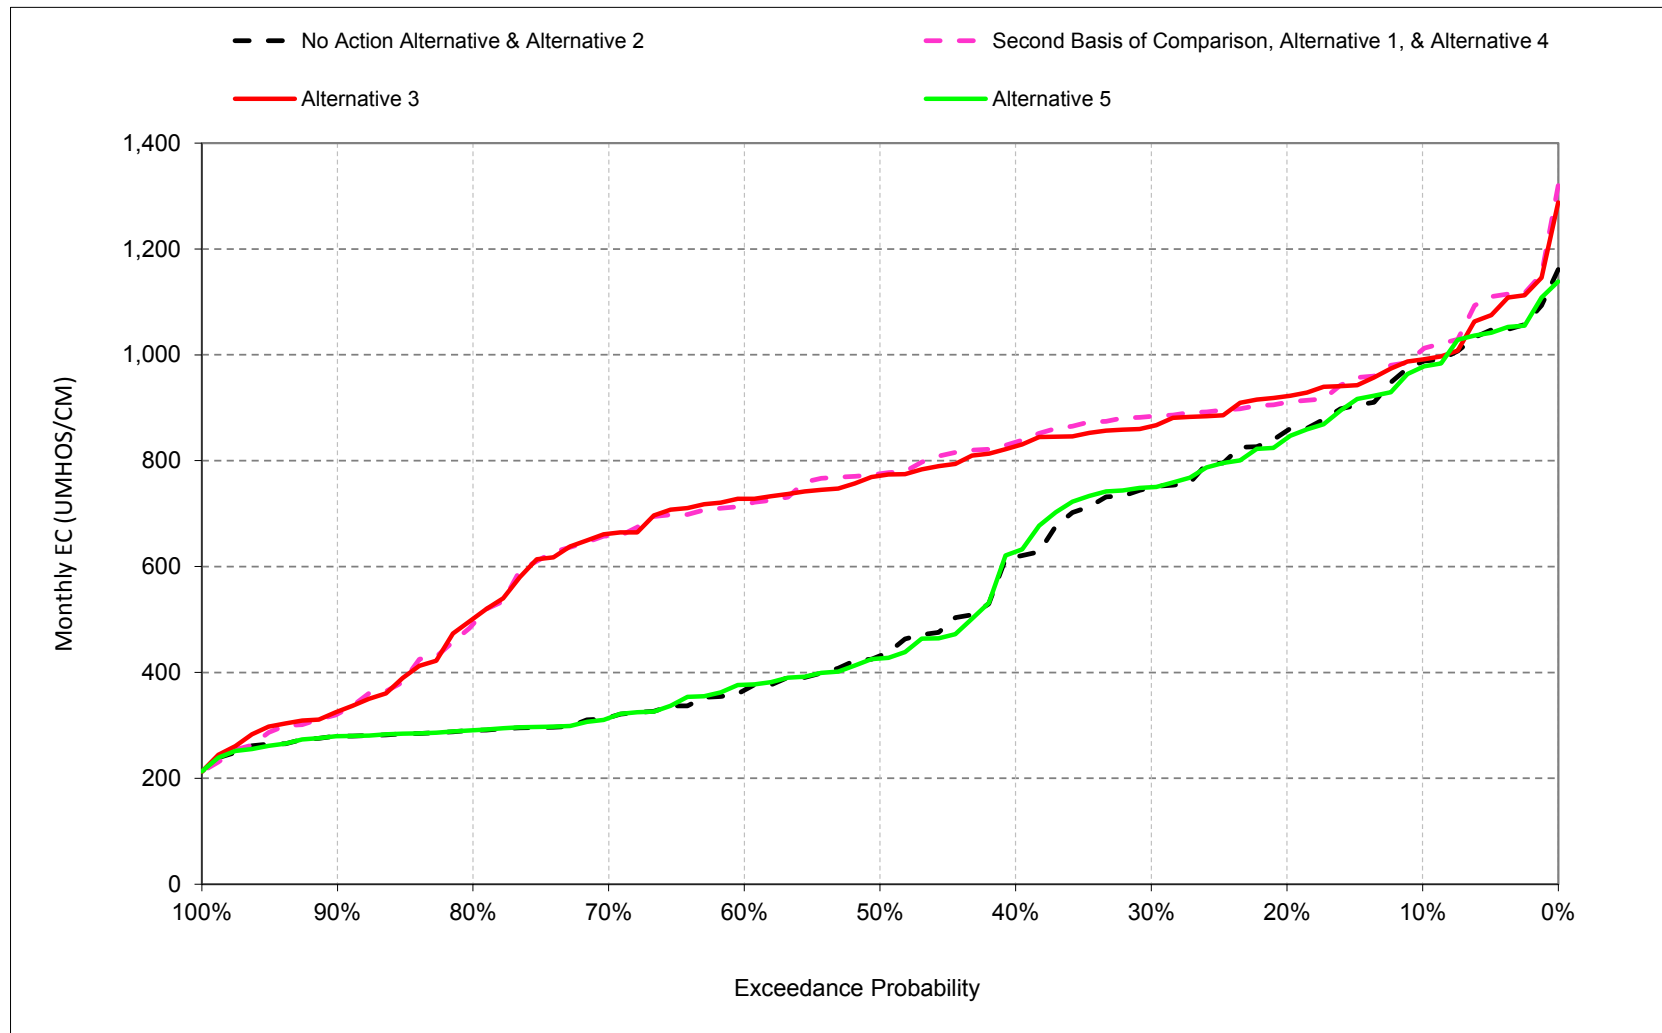


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.12.4. Contra Costa Water District Old River Intake Salinity, Electrical Conductivity, January

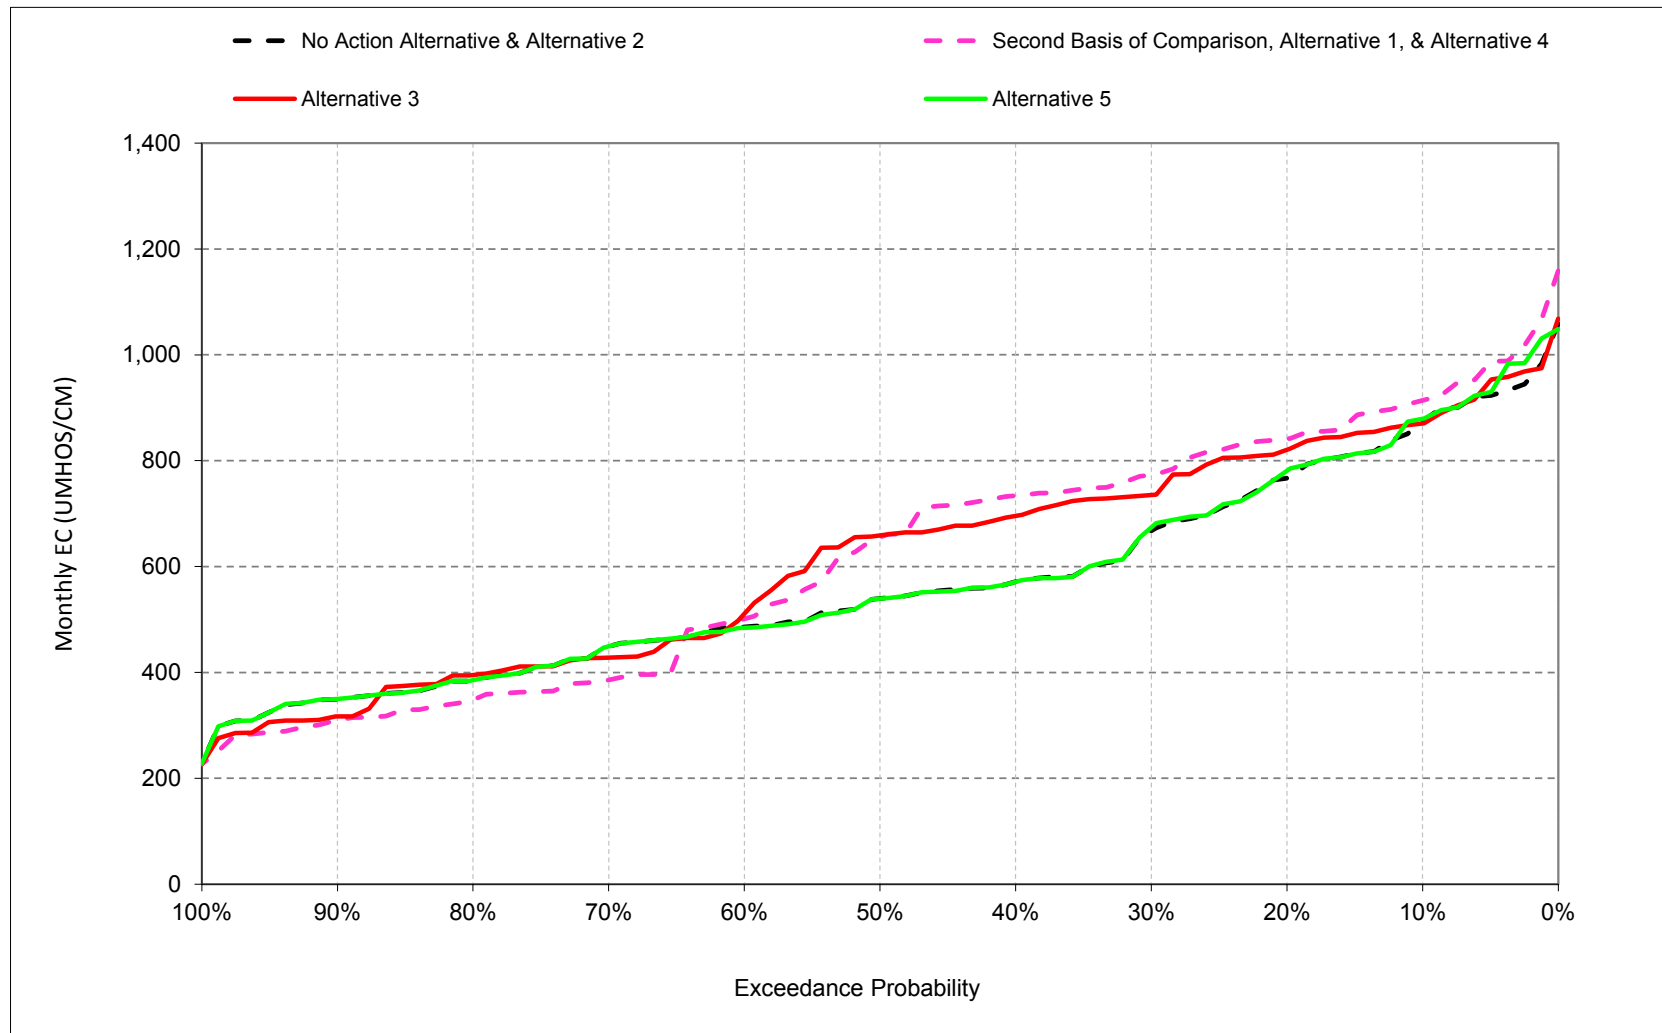


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.12.5. Contra Costa Water District Old River Intake Salinity, Electrical Conductivity, February

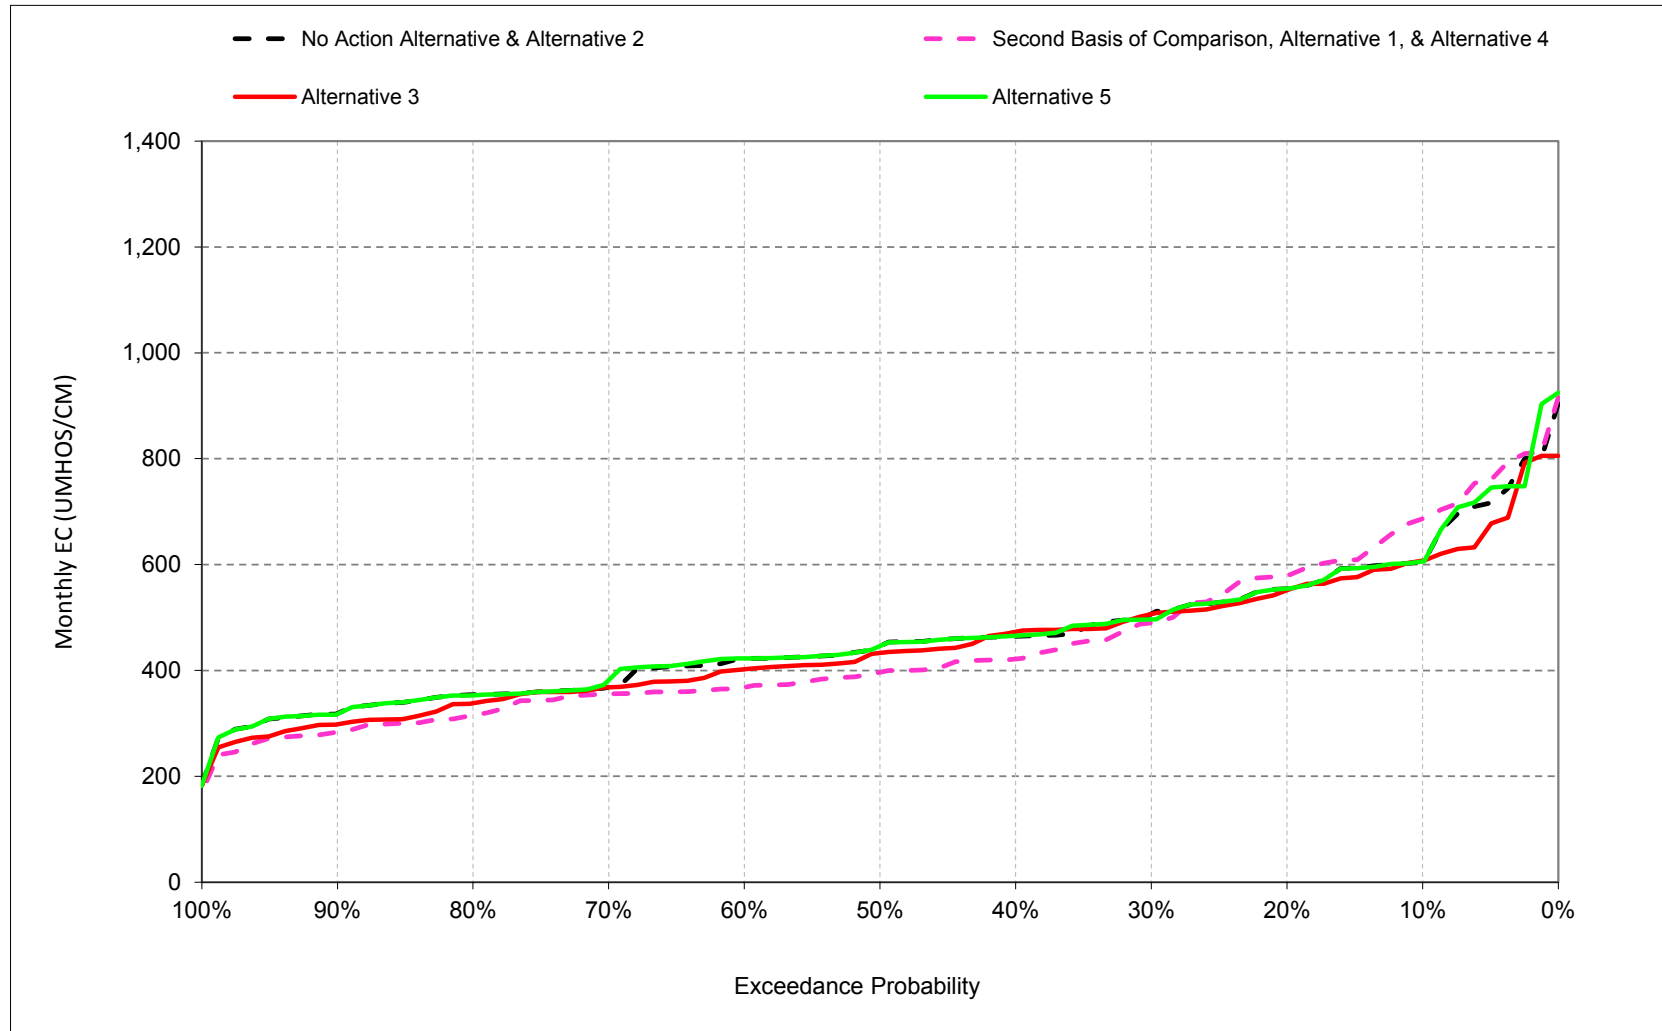


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.12.6. Contra Costa Water District Old River Intake Salinity, Electrical Conductivity, March

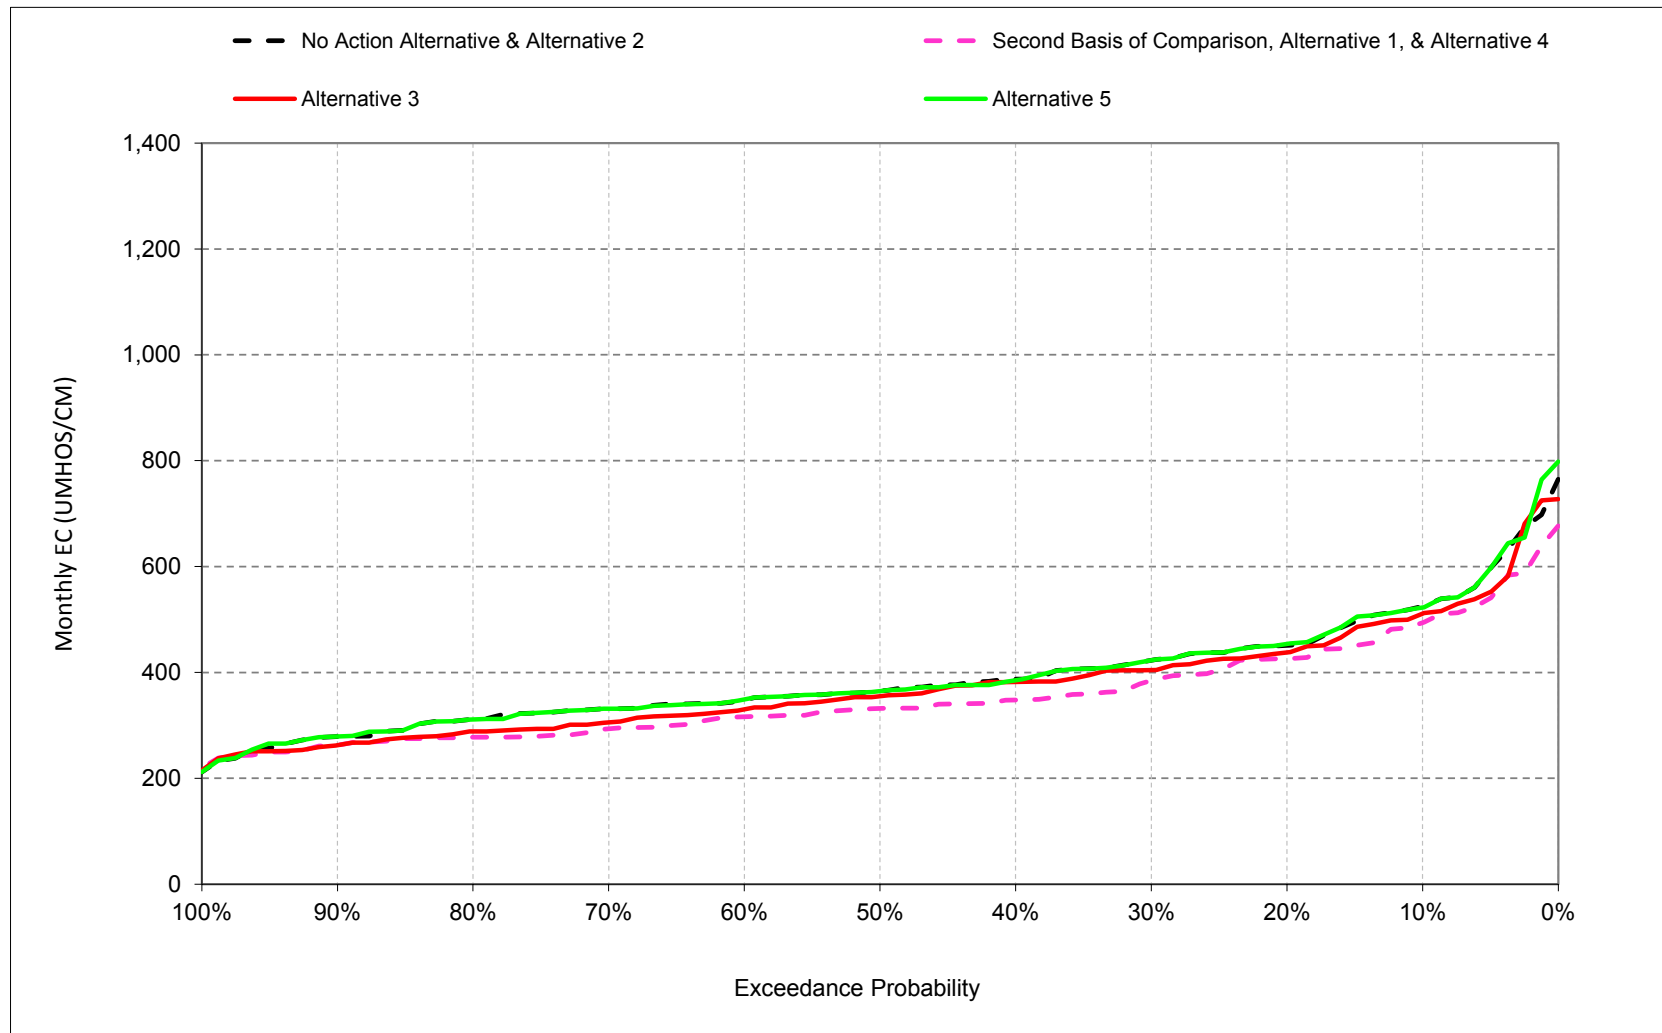


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.12.7. Contra Costa Water District Old River Intake Salinity, Electrical Conductivity, April

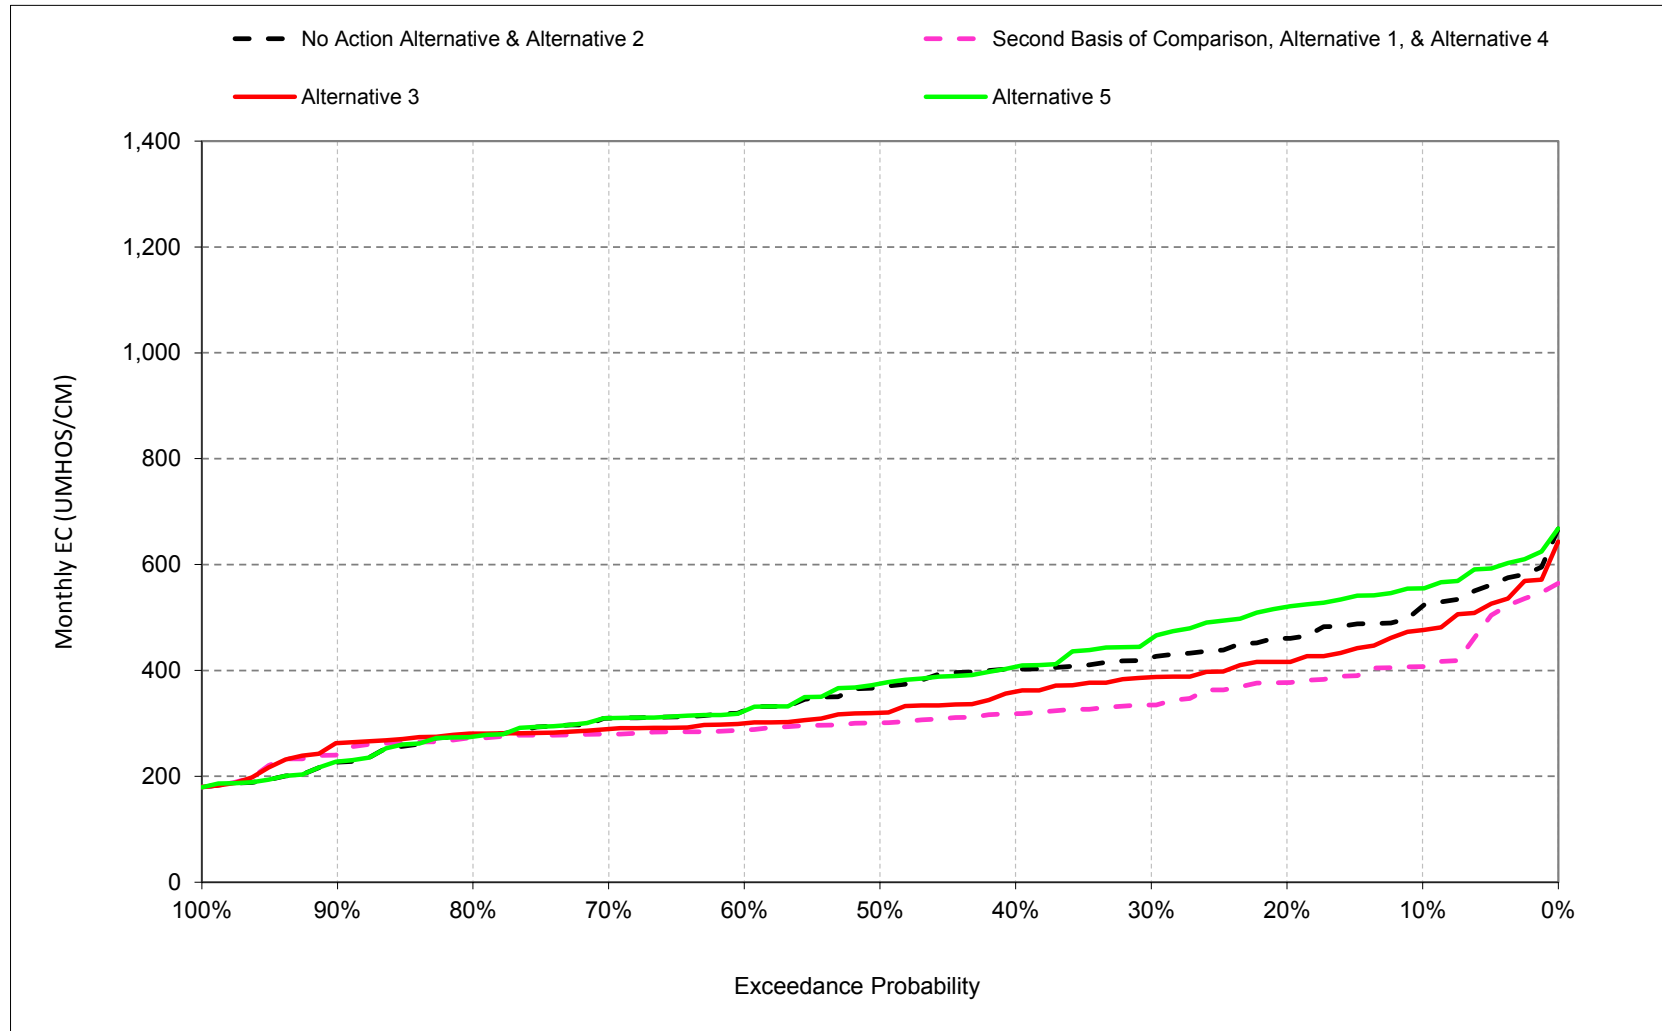


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.12.8. Contra Costa Water District Old River Intake Salinity, Electrical Conductivity, May

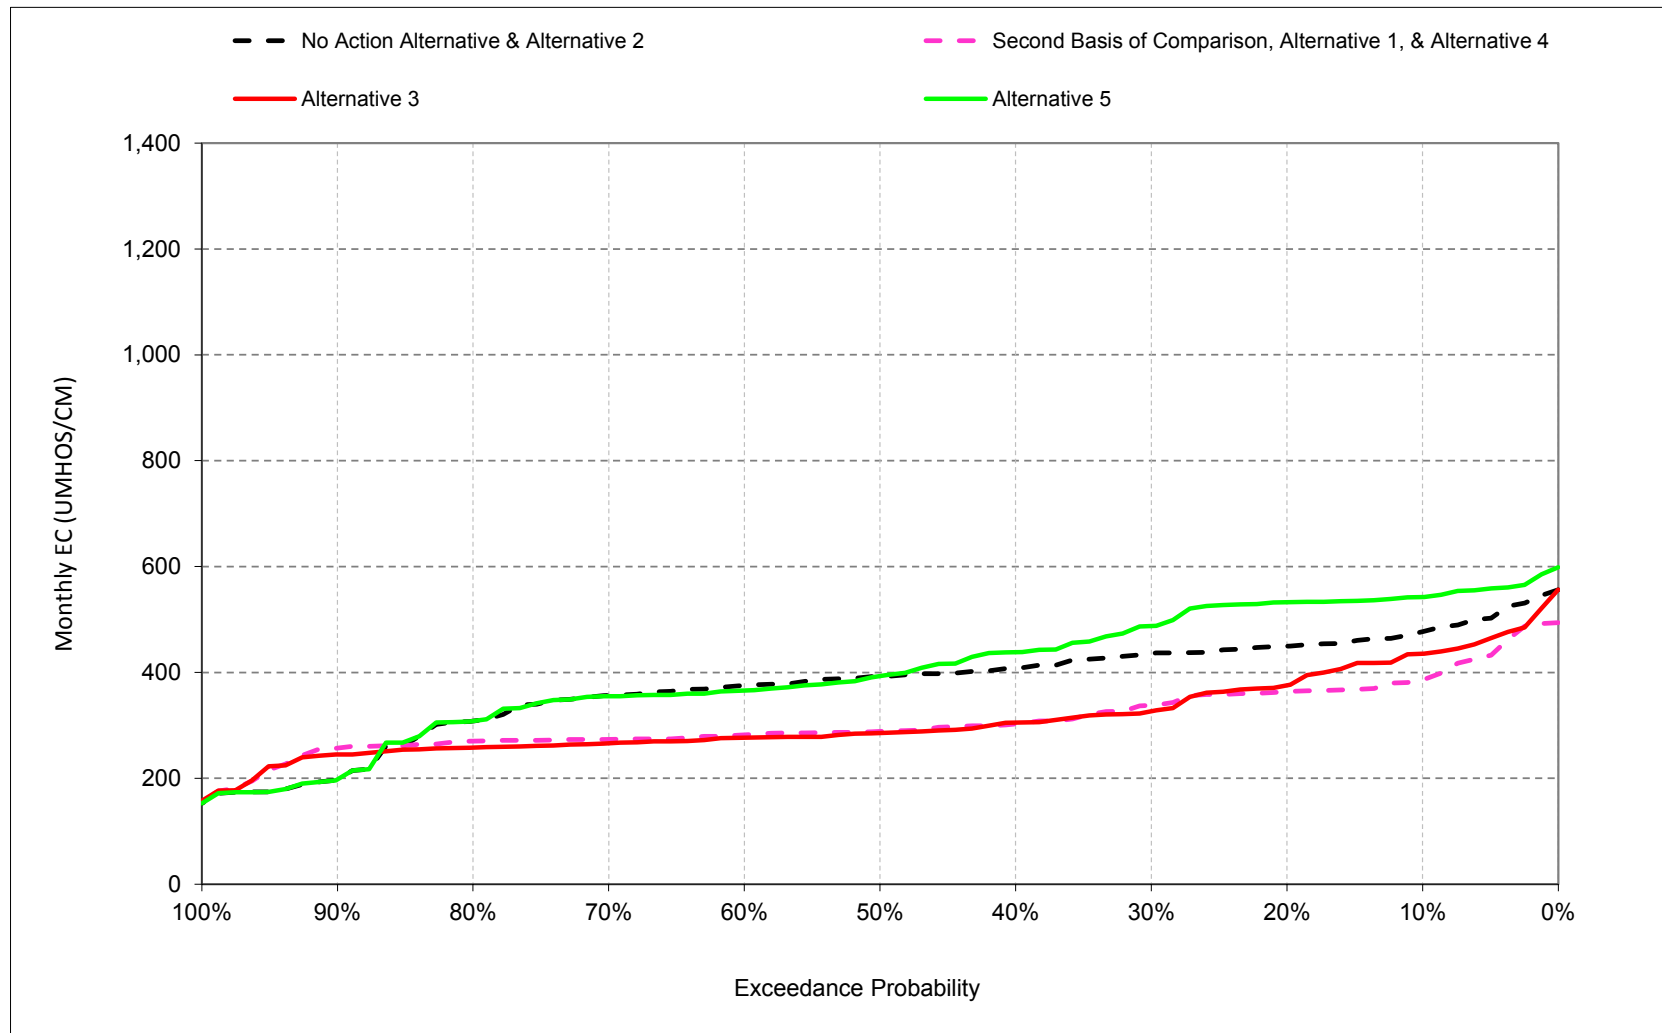


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.12.9. Contra Costa Water District Old River Intake Salinity, Electrical Conductivity, June

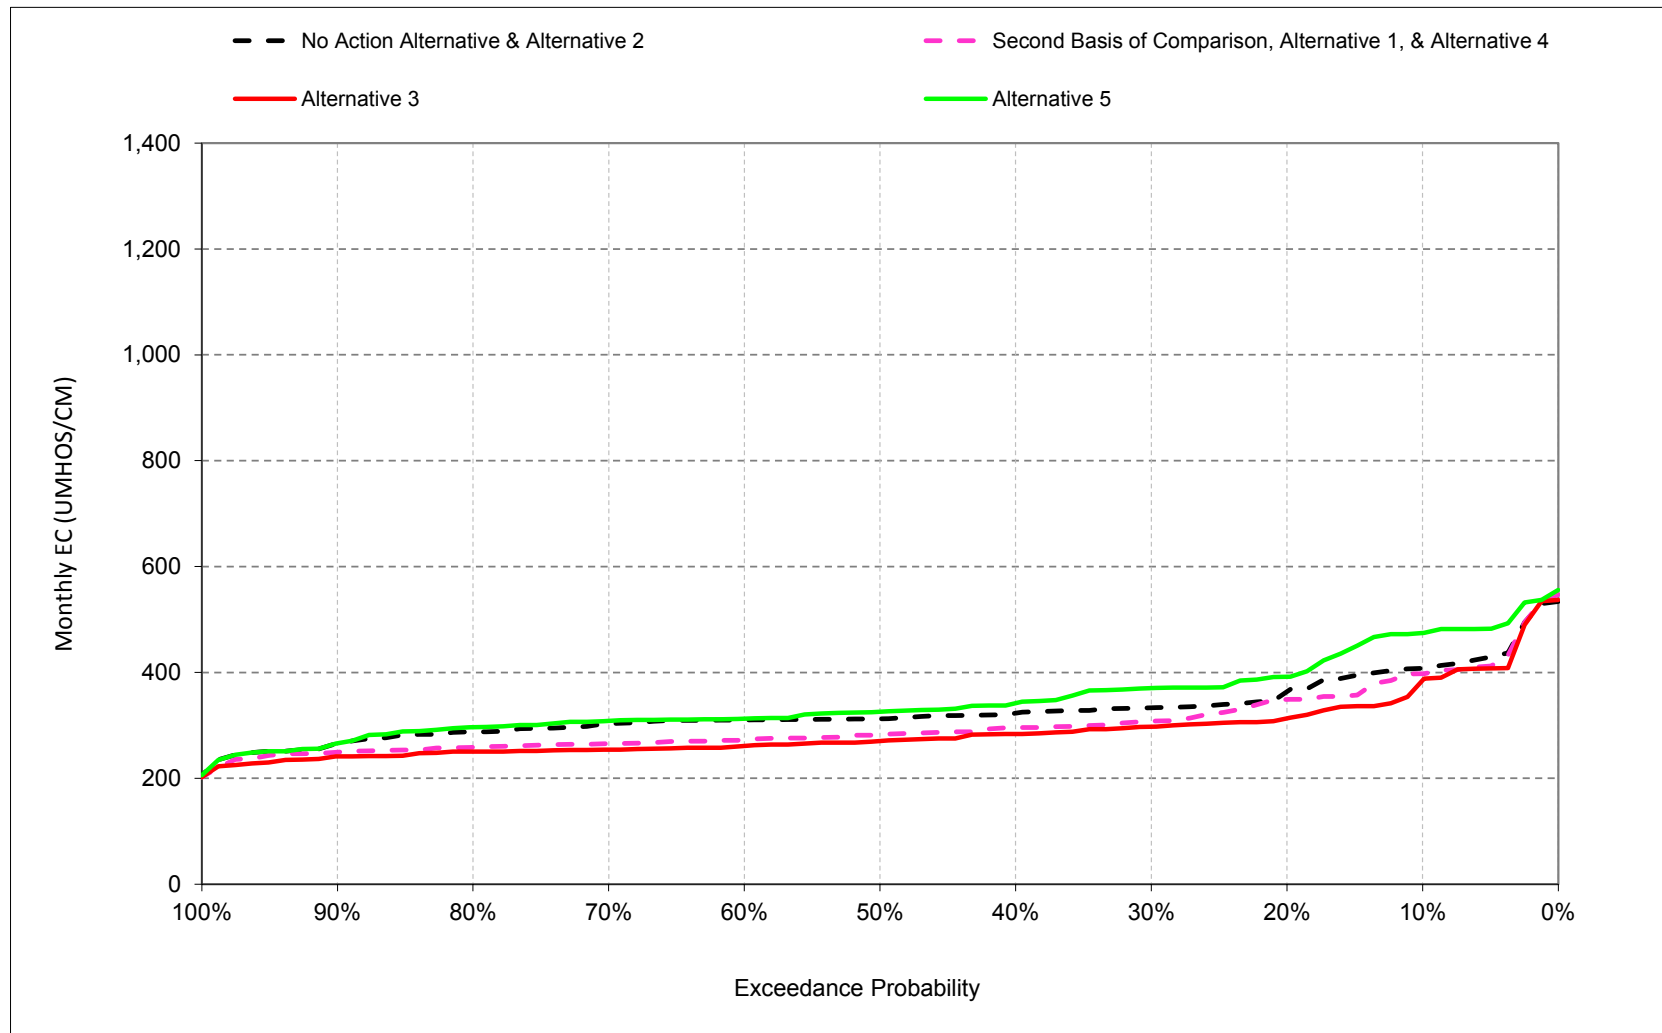


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.12.10. Contra Costa Water District Old River Intake Salinity, Electrical Conductivity, July

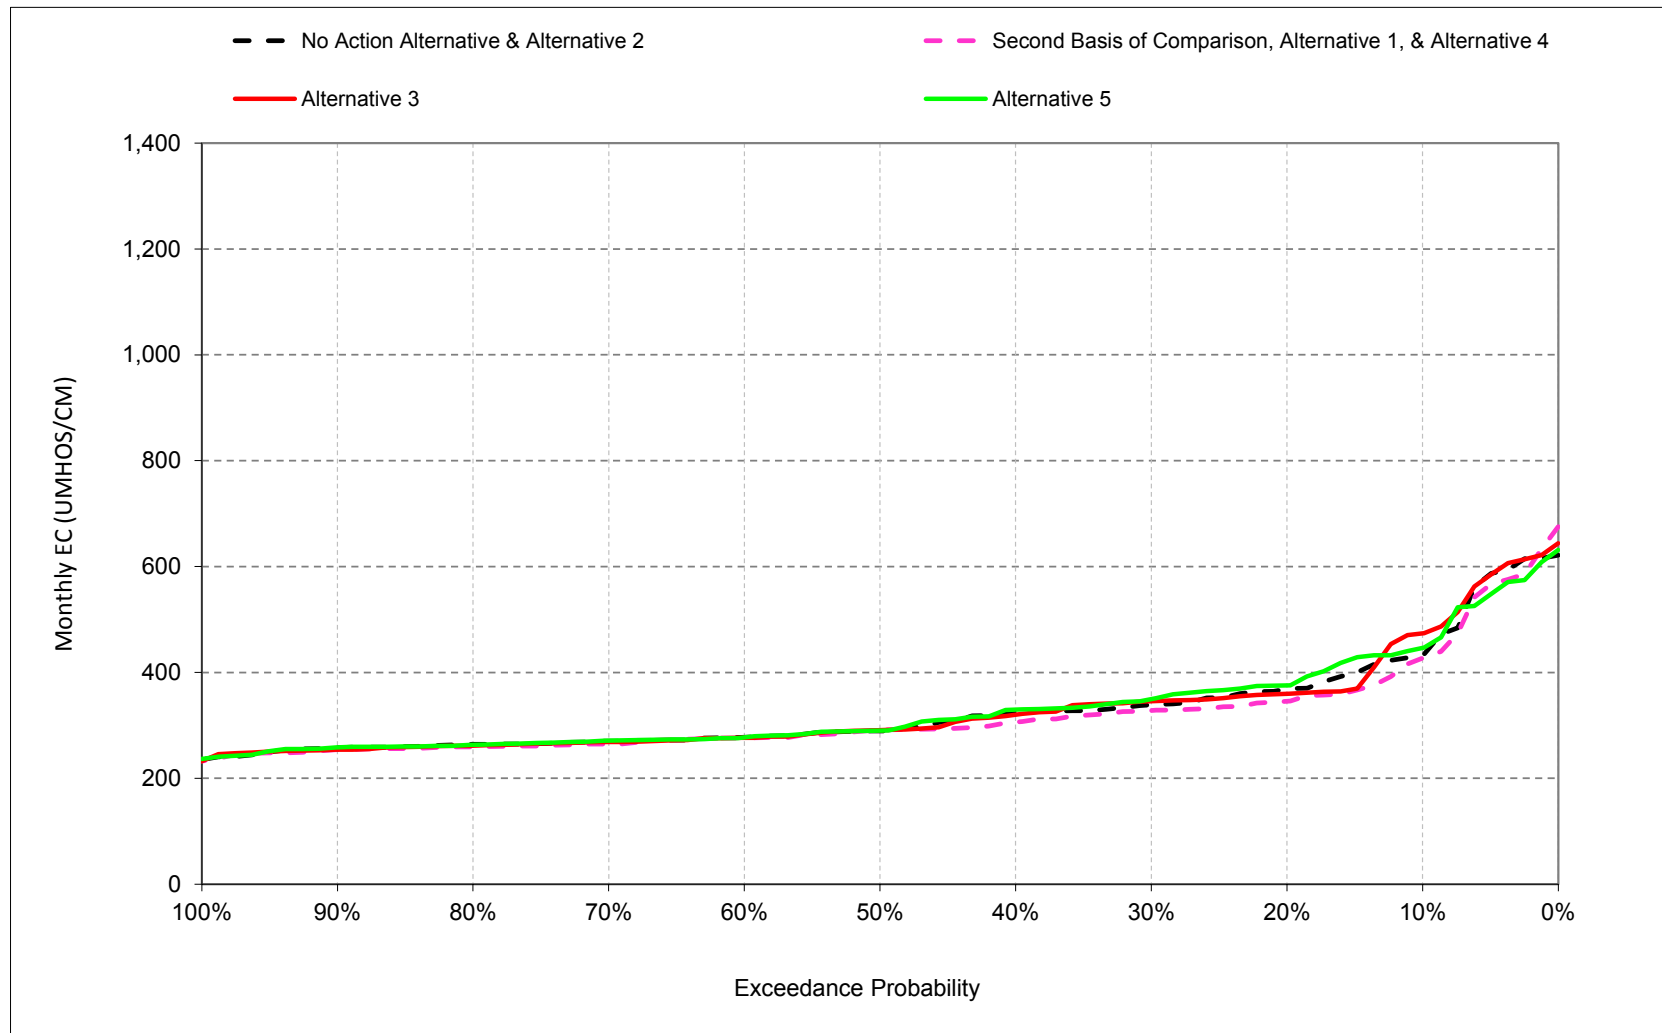


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.12.11. Contra Costa Water District Old River Intake Salinity, Electrical Conductivity, August

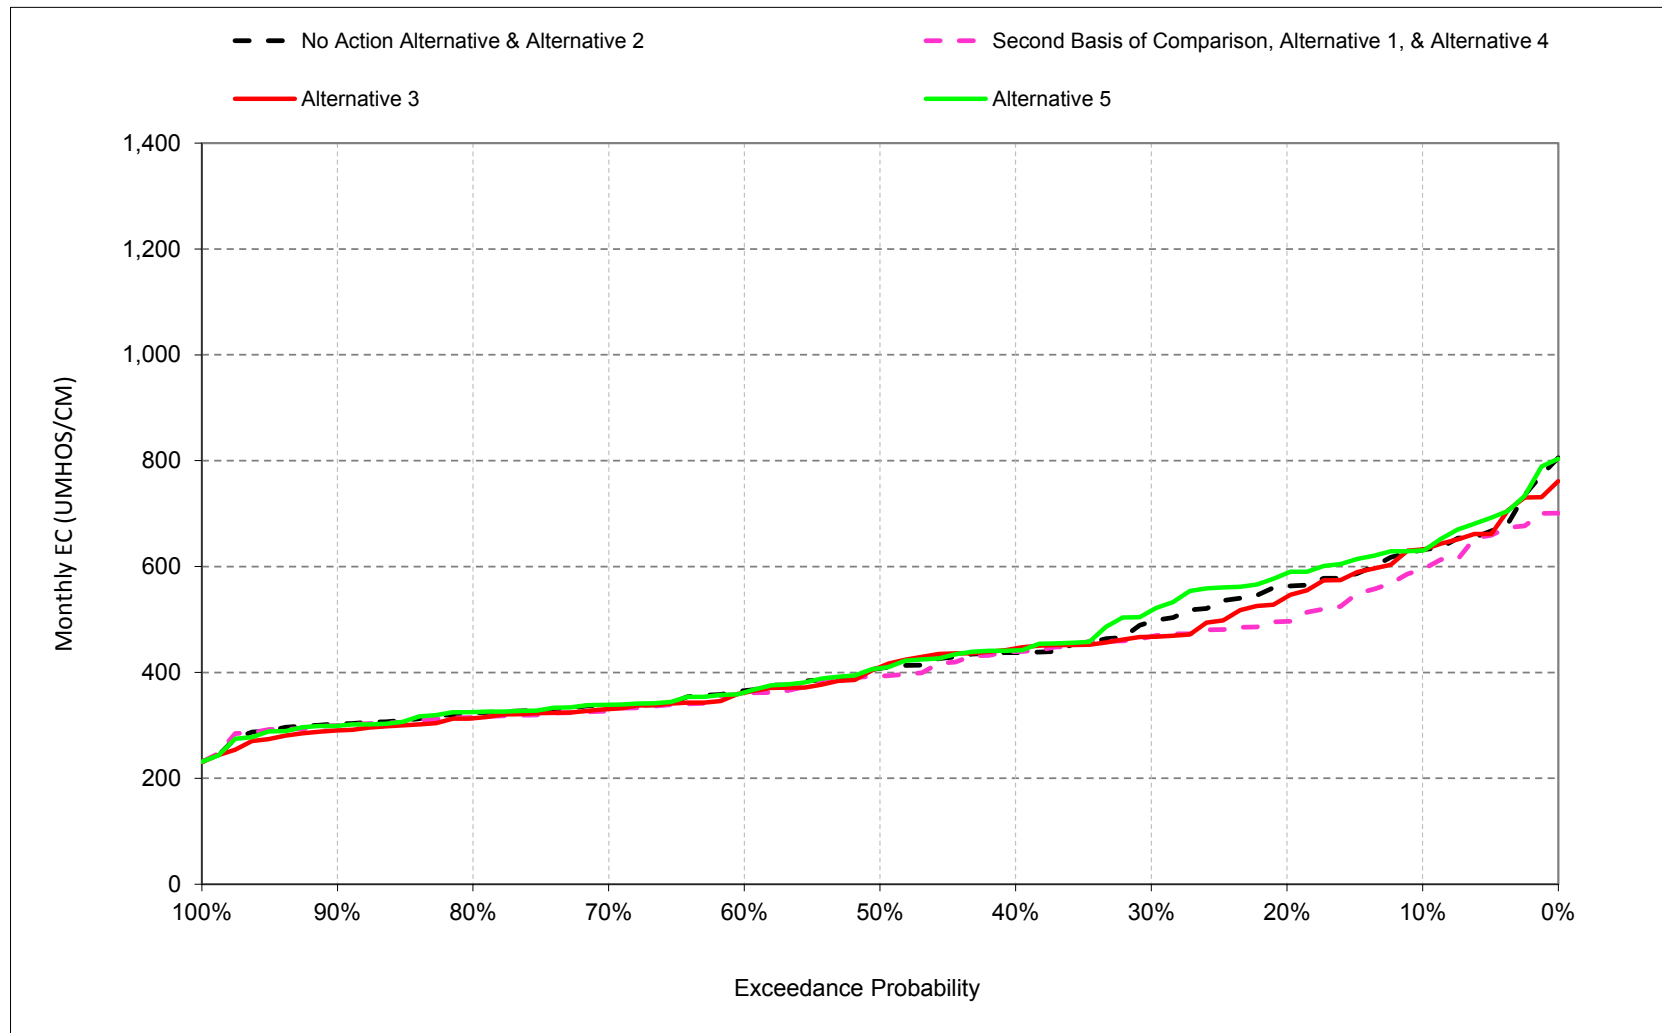

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.12.12. Contra Costa Water District Old River Intake Salinity, Electrical Conductivity, September

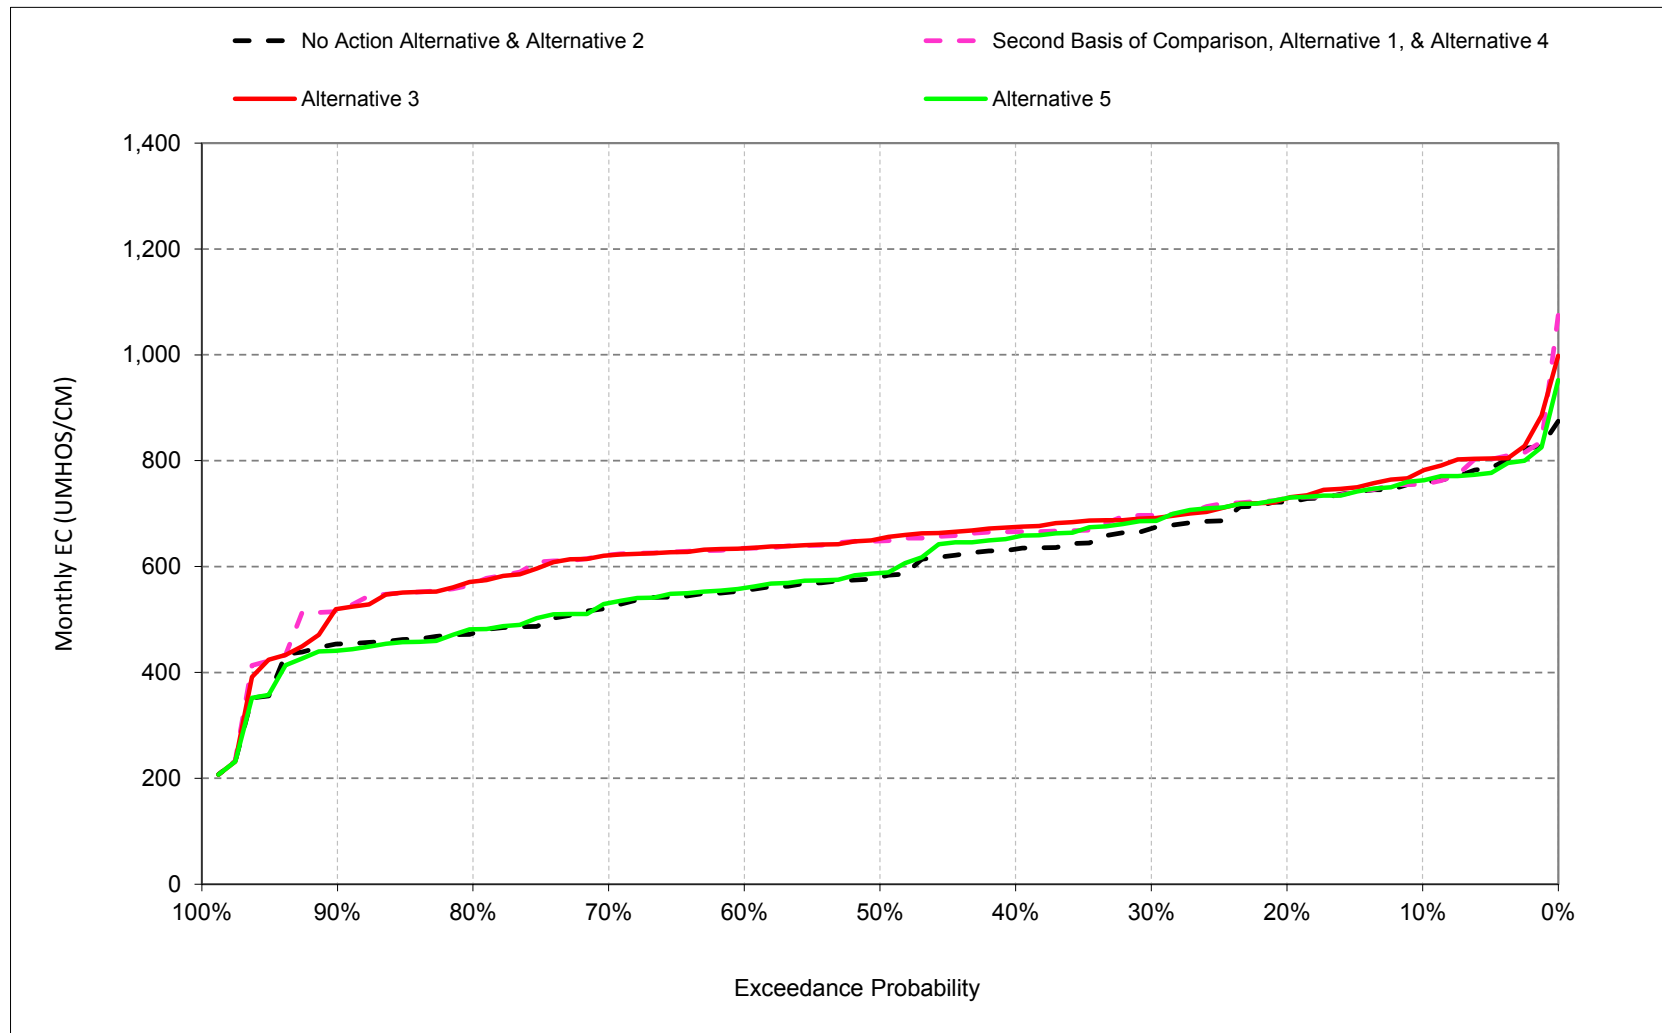

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.12.1. Contra Costa Water District Old River Intake Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	896	973	987	875	605	525	521	477	408	434	631	759
20%	843	802	857	767	554	451	461	449	364	368	563	722
30%	790	722	749	667	507	423	424	436	333	339	496	672
40%	754	680	618	571	464	387	402	408	323	325	437	633
50%	713	584	431	540	446	365	368	393	312	289	408	580
60%	337	330	366	486	422	348	324	375	310	277	366	555
70%	323	294	315	449	368	331	310	356	303	270	337	523
80%	314	274	291	385	354	311	279	308	288	264	324	474
90%	301	266	280	349	319	279	227	198	266	258	303	454
Long Term												
Full Simulation Period ^b	580	558	554	570	463	390	370	376	328	329	436	594
Water Year Types^c												
Wet (32%)	483	436	396	428	373	321	260	284	284	266	323	498
Above Normal (16%)	692	656	571	542	444	346	341	377	308	266	339	460
Below Normal (13%)	487	451	506	558	472	390	408	436	338	311	422	688
Dry (24%)	580	584	618	662	499	424	427	407	329	373	548	666
Critical (15%)	753	772	819	766	610	533	511	468	429	477	614	740

Alternative 1												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	901	968	1,010	914	687	494	407	386	397	427	595	755
20%	856	854	910	841	580	426	377	364	349	345	496	729
30%	830	804	884	773	490	385	335	338	308	328	468	697
40%	810	761	835	734	422	348	318	303	295	306	439	666
50%	789	733	775	656	396	332	301	288	283	291	393	648
60%	776	717	716	501	368	316	287	282	273	276	360	635
70%	743	691	658	386	356	294	280	274	265	265	328	624
80%	725	622	491	348	315	278	273	270	259	260	315	579
90%	661	487	321	310	283	263	242	257	250	254	300	530
Long Term												
Full Simulation Period ^b	769	729	734	614	445	356	322	310	304	320	419	646
Water Year Types^c												
Wet (32%)	706	674	583	407	339	314	266	254	267	265	313	555
Above Normal (16%)	828	750	720	598	392	314	293	278	267	261	339	654
Below Normal (13%)	722	665	736	685	541	374	333	311	275	305	425	656
Dry (24%)	785	749	825	725	487	354	338	339	313	343	493	687
Critical (15%)	855	854	923	829	575	480	436	416	431	481	603	761

Alternative 1 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	5	-5	23	39	81	-31	-114	-91	-11	-7	-36	-3
20%	13	52	54	74	26	-25	-83	-86	-15	-23	-67	7
30%	40	82	134	106	-17	-38	-89	-98	-25	-11	-28	25
40%	56	81	217	162	-43	-40	-84	-105	-28	-18	2	33
50%	77	149	344	116	-50	-33	-67	-104	-30	1	-14	68
60%	439	387	350	16	-54	-32	-37	-93	-37	-1	-6	80
70%	420	397	343	-63	-13	-38	-30	-83	-38	-6	-9	102
80%	411	348	200	-37	-39	-34	-6	-38	-29	-4	-9	105
90%	360	222	42	-40	-35	-16	15	59	-17	-4	-3	76
Long Term												
Full Simulation Period ^b	189	171	180	44	-18	-34	-49	-67	-24	-9	-18	53
Water Year Types^c												
Wet (32%)	223	237	187	-21	-34	-7	5	-31	-17	-1	-10	57
Above Normal (16%)	136	94	149	56	-52	-32	-49	-99	-41	-5	0	193
Below Normal (13%)	235	214	230	127	69	-16	-75	-125	-62	-6	2	-32
Dry (24%)	206	165	208	63	-11	-70	-89	-69	-16	-30	-54	21
Critical (15%)	102	82	104	63	-34	-53	-74	-52	2	4	-11	21

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.12.2. Contra Costa Water District Old River Intake Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	896	973	987	875	605	525	521	477	408	434	631	759
20%	843	802	857	767	554	451	461	449	364	368	563	722
30%	790	722	749	667	507	423	424	436	333	339	496	672
40%	754	680	618	571	464	387	402	408	323	325	437	633
50%	713	584	431	540	446	365	368	393	312	289	408	580
60%	337	330	366	486	422	348	324	375	310	277	366	555
70%	323	294	315	449	368	331	310	356	303	270	337	523
80%	314	274	291	385	354	311	279	308	288	264	324	474
90%	301	266	280	349	319	279	227	198	266	258	303	454
Long Term												
Full Simulation Period ^b	580	558	554	570	463	390	370	376	328	329	436	594
Water Year Types^c												
Wet (32%)	483	436	396	428	373	321	260	284	284	266	323	498
Above Normal (16%)	692	656	571	542	444	346	341	377	308	266	339	460
Below Normal (13%)	487	451	506	558	472	390	408	436	338	311	422	688
Dry (24%)	580	584	618	662	499	424	427	407	329	373	548	666
Critical (15%)	753	772	819	766	610	533	511	468	429	477	614	740

Alternative 3												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	902	953	991	870	607	511	476	435	385	474	632	781
20%	862	864	922	821	552	438	416	375	313	360	543	729
30%	821	800	865	735	507	404	387	326	297	346	467	695
40%	806	750	827	696	473	382	360	305	284	320	445	676
50%	784	731	771	659	433	355	320	286	271	291	410	658
60%	758	714	728	511	402	330	300	277	261	276	362	637
70%	743	699	662	428	368	305	289	266	254	269	331	623
80%	720	646	501	395	338	289	281	258	250	262	313	576
90%	660	532	326	317	298	263	263	245	241	254	290	525
Long Term												
Full Simulation Period ^b	767	740	730	612	447	375	347	313	291	330	428	648
Water Year Types^c												
Wet (32%)	700	684	588	442	354	307	271	247	253	266	309	541
Above Normal (16%)	843	778	724	623	423	322	294	272	258	265	338	659
Below Normal (13%)	722	656	738	672	485	371	360	328	282	325	440	703
Dry (24%)	775	767	829	714	487	410	390	340	291	370	526	682
Critical (15%)	854	852	872	742	574	522	486	443	416	478	609	759

Alternative 3 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	6	-19	4	-4	2	-14	-45	-42	-23	40	1	22
20%	20	61	65	54	-3	-14	-44	-74	-50	-9	-20	7
30%	31	79	116	68	0	-18	-37	-109	-36	7	-29	23
40%	52	70	209	124	8	-5	-42	-103	-39	-5	8	43
50%	71	147	340	119	-13	-10	-49	-107	-42	2	3	78
60%	422	384	362	25	-20	-18	-24	-99	-49	-1	-4	82
70%	420	405	347	-22	0	-26	-21	-90	-49	-2	-6	100
80%	406	372	210	10	-16	-23	2	-50	-38	-3	-11	102
90%	359	266	47	-32	-20	-16	36	47	-25	-4	-13	71
Long Term												
Full Simulation Period ^b	187	182	176	42	-16	-16	-23	-63	-37	1	-8	54
Water Year Types^c												
Wet (32%)	217	247	192	14	-19	-14	11	-37	-32	-1	-13	43
Above Normal (16%)	151	123	154	81	-21	-24	-48	-105	-51	-2	-1	199
Below Normal (13%)	235	205	232	114	13	-19	-48	-108	-56	14	17	16
Dry (24%)	195	182	211	52	-12	-14	-37	-68	-38	-3	-22	16
Critical (15%)	101	81	53	-24	-36	-11	-25	-25	-14	1	-5	20

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.12.3. Contra Costa Water District Old River Intake Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	896	973	987	875	605	525	521	477	408	434	631	759
20%	843	802	857	767	554	451	461	449	364	368	563	722
30%	790	722	749	667	507	423	424	436	333	339	496	672
40%	754	680	618	571	464	387	402	408	323	325	437	633
50%	713	584	431	540	446	365	368	393	312	289	408	580
60%	337	330	366	486	422	348	324	375	310	277	366	555
70%	323	294	315	449	368	331	310	356	303	270	337	523
80%	314	274	291	385	354	311	279	308	288	264	324	474
90%	301	266	280	349	319	279	227	198	266	258	303	454
Long Term												
Full Simulation Period ^b	580	558	554	570	463	390	370	376	328	329	436	594
Water Year Types ^c												
Wet (32%)	483	436	396	428	373	321	260	284	284	266	323	498
Above Normal (16%)	692	656	571	542	444	346	341	377	308	266	339	460
Below Normal (13%)	487	451	506	558	472	390	408	436	338	311	422	688
Dry (24%)	580	584	618	662	499	424	427	407	329	373	548	666
Critical (15%)	753	772	819	766	610	533	511	468	429	477	614	740

Alternative 5												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	912	970	977	879	606	522	555	542	475	446	631	763
20%	853	827	843	781	555	454	520	533	392	376	588	729
30%	801	734	750	674	496	423	460	488	370	350	517	686
40%	766	671	628	571	465	385	407	438	342	330	442	656
50%	709	595	426	540	446	365	375	393	326	290	408	588
60%	340	328	377	484	423	349	323	366	313	277	362	559
70%	324	288	314	449	382	331	310	355	309	271	339	531
80%	314	276	291	385	353	311	275	308	297	263	325	482
90%	301	266	280	350	318	279	228	198	266	259	299	443
Long Term												
Full Simulation Period ^b	584	560	555	572	465	391	386	401	348	332	444	600
Water Year Types ^c												
Wet (32%)	485	443	403	428	376	321	261	278	286	266	322	496
Above Normal (16%)	706	654	563	540	444	346	338	364	313	267	338	459
Below Normal (13%)	486	453	506	557	470	388	398	435	357	315	423	695
Dry (24%)	585	582	615	671	502	425	464	480	372	388	574	685
Critical (15%)	756	772	818	766	617	540	568	546	475	468	623	752

Alternative 5 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	16	-3	-10	5	0	-3	34	65	67	12	-1	4
20%	10	25	-14	14	1	3	60	83	28	7	25	7
30%	11	12	1	6	-11	0	36	52	37	11	21	14
40%	12	-8	10	0	1	-2	5	30	19	5	4	23
50%	-4	11	-5	0	0	0	7	1	14	1	1	8
60%	3	-2	10	-1	1	1	-1	-9	3	0	-3	5
70%	1	-6	-1	0	13	0	0	-2	5	1	2	8
80%	-1	2	0	0	-1	0	-4	0	9	-1	1	8
90%	0	0	0	0	-1	1	1	0	0	1	-4	-11
Long Term												
Full Simulation Period ^b	4	2	0	2	2	1	16	25	21	3	8	7
Water Year Types ^c												
Wet (32%)	1	7	8	0	2	0	0	-6	1	0	0	-2
Above Normal (16%)	14	-1	-8	-2	0	0	-3	-12	5	1	-1	-1
Below Normal (13%)	-1	3	0	-1	-2	-2	-10	-1	20	4	1	8
Dry (24%)	5	-3	-3	9	3	1	37	72	42	15	27	19
Critical (15%)	3	0	-1	0	7	7	58	78	46	-8	9	12

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.12.4. Contra Costa Water District Old River Intake Salinity, Monthly EC

Second Basis of Comparison												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	901	968	1,010	914	687	494	407	386	397	427	595	755
20%	856	854	910	841	580	426	377	364	349	345	496	729
30%	830	804	884	773	490	385	335	338	308	328	468	697
40%	810	761	835	734	422	348	318	303	295	306	439	666
50%	789	733	775	656	396	332	301	288	283	291	393	648
60%	776	717	716	501	368	316	287	282	273	276	360	635
70%	743	691	658	386	356	294	280	274	265	265	328	624
80%	725	622	491	348	315	278	273	270	259	260	315	579
90%	661	487	321	310	283	263	242	257	250	254	300	530
Long Term												
Full Simulation Period ^b	769	729	734	614	445	356	322	310	304	320	419	646
Water Year Types^c												
Wet (32%)	706	674	583	407	339	314	266	254	267	265	313	555
Above Normal (16%)	828	750	720	598	392	314	293	278	267	261	339	654
Below Normal (13%)	722	665	736	685	541	374	333	311	275	305	425	656
Dry (24%)	785	749	825	725	487	354	338	339	313	343	493	687
Critical (15%)	855	854	923	829	575	480	436	416	431	481	603	761
No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	896	973	987	875	605	525	521	477	408	434	631	759
20%	843	802	857	767	554	451	461	449	364	368	563	722
30%	790	722	749	667	507	423	424	436	333	339	496	672
40%	754	680	618	571	464	387	402	408	323	325	437	633
50%	713	584	431	540	446	365	368	393	312	289	408	580
60%	337	330	366	486	422	348	324	375	310	277	366	555
70%	323	294	315	449	368	331	310	356	303	270	337	523
80%	314	274	291	385	354	311	279	308	288	264	324	474
90%	301	266	280	349	319	279	227	198	266	258	303	454
Long Term												
Full Simulation Period ^b	580	558	554	570	463	390	370	376	328	329	436	594
Water Year Types^c												
Wet (32%)	483	436	396	428	373	321	260	284	284	266	323	498
Above Normal (16%)	692	656	571	542	444	346	341	377	308	266	339	460
Below Normal (13%)	487	451	506	558	472	390	408	436	338	311	422	688
Dry (24%)	580	584	618	662	499	424	427	407	329	373	548	666
Critical (15%)	753	772	819	766	610	533	511	468	429	477	614	740
No Action Alternative minus Second Basis of Comparison												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-5	5	-23	-39	-81	31	114	91	11	7	36	3
20%	-13	-52	-54	-74	-26	25	83	86	15	23	67	-7
30%	-40	-82	-134	-106	17	38	89	98	25	11	28	-25
40%	-56	-81	-217	-162	43	40	84	105	28	18	-2	-33
50%	-77	-149	-344	-116	50	33	67	104	30	-1	14	-68
60%	-439	-387	-350	-16	54	32	37	93	37	1	6	-80
70%	-420	-397	-343	63	13	38	30	83	38	6	9	-102
80%	-411	-348	-200	37	39	34	6	38	29	4	9	-105
90%	-360	-222	-42	40	35	16	-15	-59	17	4	3	-76
Long Term												
Full Simulation Period ^b	-189	-171	-180	-44	18	34	49	67	24	9	18	-53
Water Year Types^c												
Wet (32%)	-223	-237	-187	21	34	7	-5	31	17	1	10	-57
Above Normal (16%)	-136	-94	-149	-56	52	32	49	99	41	5	0	-193
Below Normal (13%)	-235	-214	-230	-127	-69	16	75	125	62	6	-2	32
Dry (24%)	-206	-165	-208	-63	11	70	89	69	16	30	54	-21
Critical (15%)	-102	-82	-104	-63	34	53	74	52	-2	-4	11	-21

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
b Based on the 82-year simulation period.
c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.12.5. Contra Costa Water District Old River Intake Salinity, Monthly EC

Second Basis of Comparison

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	901	968	1,010	914	687	494	407	386	397	427	595	755
20%	856	854	910	841	580	426	377	364	349	345	496	729
30%	830	804	884	773	490	385	335	338	308	328	468	697
40%	810	761	835	734	422	348	318	303	295	306	439	666
50%	789	733	775	656	396	332	301	288	283	291	393	648
60%	776	717	716	501	368	316	287	282	273	276	360	635
70%	743	691	658	386	356	294	280	274	265	265	328	624
80%	725	622	491	348	315	278	273	270	259	260	315	579
90%	661	487	321	310	283	263	242	257	250	254	300	530
Long Term												
Full Simulation Period ^b	769	729	734	614	445	356	322	310	304	320	419	646
Water Year Types^c												
Wet (32%)	706	674	583	407	339	314	266	254	267	265	313	555
Above Normal (16%)	828	750	720	598	392	314	293	278	267	261	339	654
Below Normal (13%)	722	665	736	685	541	374	333	311	275	305	425	656
Dry (24%)	785	749	825	725	487	354	338	339	313	343	493	687
Critical (15%)	855	854	923	829	575	480	436	416	431	481	603	761

Alternative 3

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	902	953	991	870	607	511	476	435	385	474	632	781
20%	862	864	922	821	552	438	416	375	313	360	543	729
30%	821	800	865	735	507	404	387	326	297	346	467	695
40%	806	750	827	696	473	382	360	305	284	320	445	676
50%	784	731	771	659	433	355	320	286	271	291	410	658
60%	758	714	728	511	402	330	300	277	261	276	362	637
70%	743	699	662	428	368	305	289	266	254	269	331	623
80%	720	646	501	395	338	289	281	258	250	262	313	576
90%	660	532	326	317	298	263	263	245	241	254	290	525
Long Term												
Full Simulation Period ^b	767	740	730	612	447	375	347	313	291	330	428	648
Water Year Types^c												
Wet (32%)	700	684	588	442	354	307	271	247	253	266	309	541
Above Normal (16%)	843	778	724	623	423	322	294	272	258	265	338	659
Below Normal (13%)	722	656	738	672	485	371	360	328	282	325	440	703
Dry (24%)	775	767	829	714	487	410	390	340	291	370	526	682
Critical (15%)	854	852	872	742	574	522	486	443	416	478	609	759

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1	-15	-19	-44	-79	17	69	49	-13	47	37	25
20%	6	10	12	-21	-29	11	39	11	-36	14	47	-1
30%	-9	-3	-19	-38	17	20	52	-12	-11	17	-1	-2
40%	-4	-10	-8	-38	51	34	42	2	-12	14	6	11
50%	-5	-2	-4	3	37	23	19	-3	-12	0	17	10
60%	-17	-3	12	10	34	14	13	-5	-12	0	2	2
70%	0	8	4	42	13	12	9	-8	-11	4	3	-1
80%	-5	24	10	47	23	11	8	-12	-8	2	-2	-3
90%	-1	45	5	7	15	0	21	-12	-8	0	-10	-5
Long Term												
Full Simulation Period ^b	-2	11	-4	-2	2	19	25	3	-13	10	10	2
Water Year Types^c												
Wet (32%)	-6	10	5	35	15	-7	5	-7	-15	1	-4	-14
Above Normal (16%)	15	28	5	25	31	9	1	-6	-10	3	-1	5
Below Normal (13%)	0	-9	2	-13	-56	-3	28	16	6	20	15	48
Dry (24%)	-10	17	4	-11	-1	56	52	1	-22	27	33	-5
Critical (15%)	-1	-1	-51	-87	-1	42	49	27	-16	-3	6	-1

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.12.6. Contra Costa Water District Old River Intake Salinity, Monthly EC

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	901	968	1,010	914	687	494	407	386	397	427	595	755
20%	856	854	910	841	580	426	377	364	349	345	496	729
30%	830	804	884	773	490	385	335	338	308	328	468	697
40%	810	761	835	734	422	348	318	303	295	306	439	666
50%	789	733	775	656	396	332	301	288	283	291	393	648
60%	776	717	716	501	368	316	287	282	273	276	360	635
70%	743	691	658	386	356	294	280	274	265	265	328	624
80%	725	622	491	348	315	278	273	270	259	260	315	579
90%	661	487	321	310	283	263	242	257	250	254	300	530
Long Term												
Full Simulation Period ^b	769	729	734	614	445	356	322	310	304	320	419	646
Water Year Types ^c												
Wet (32%)	706	674	583	407	339	314	266	254	267	265	313	555
Above Normal (16%)	828	750	720	598	392	314	293	278	267	261	339	654
Below Normal (13%)	722	665	736	685	541	374	333	311	275	305	425	656
Dry (24%)	785	749	825	725	487	354	338	339	313	343	493	687
Critical (15%)	855	854	923	829	575	480	436	416	431	481	603	761

Alternative 5

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	912	970	977	879	606	522	555	542	475	446	631	763
20%	853	827	843	781	555	454	520	533	392	376	588	729
30%	801	734	750	674	496	423	460	488	370	350	517	686
40%	766	671	628	571	465	385	407	438	342	330	442	656
50%	709	595	426	540	446	365	375	393	326	290	408	588
60%	340	328	377	484	423	349	323	366	313	277	362	559
70%	324	288	314	449	382	331	310	355	309	271	339	531
80%	314	276	291	385	353	311	275	308	297	263	325	482
90%	301	266	280	350	318	279	228	198	266	259	299	443
Long Term												
Full Simulation Period ^b	584	560	555	572	465	391	386	401	348	332	444	600
Water Year Types ^c												
Wet (32%)	485	443	403	428	376	321	261	278	286	266	322	496
Above Normal (16%)	706	654	563	540	444	346	338	364	313	267	338	459
Below Normal (13%)	486	453	506	557	470	388	398	435	357	315	423	695
Dry (24%)	585	582	615	671	502	425	464	480	372	388	574	685
Critical (15%)	756	772	818	766	617	540	568	546	475	468	623	752

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	11	2	-33	-35	-81	29	148	156	77	19	36	7
20%	-3	-27	-67	-60	-25	28	143	169	43	30	91	0
30%	-29	-70	-134	-99	7	38	125	150	63	21	49	-11
40%	-44	-89	-207	-163	44	37	89	135	47	24	2	-10
50%	-80	-139	-349	-116	50	33	74	105	43	-1	15	-61
60%	-436	-389	-339	-17	55	32	36	84	40	1	3	-76
70%	-420	-403	-344	63	26	38	30	81	43	7	11	-94
80%	-412	-347	-200	37	38	34	2	38	38	4	10	-97
90%	-360	-221	-42	40	35	16	-14	-59	17	5	-1	-87
Long Term												
Full Simulation Period ^b	-184	-169	-179	-42	20	35	64	91	45	12	25	-46
Water Year Types ^c												
Wet (32%)	-221	-230	-179	22	37	7	-5	25	18	2	9	-59
Above Normal (16%)	-122	-96	-157	-58	52	32	46	86	46	6	-1	-195
Below Normal (13%)	-236	-211	-231	-127	-71	14	65	123	82	10	-2	40
Dry (24%)	-200	-167	-211	-54	15	71	126	141	58	45	81	-2
Critical (15%)	-98	-82	-105	-63	41	60	132	130	44	-13	20	-9

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.


^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1 **B.13. Contra Costa Water District Victoria Canal Intake Salinity**


2

Figure 6E.B.13.1. Contra Costa Victoria Canal Intake Salinity, Electrical Conductivity, October

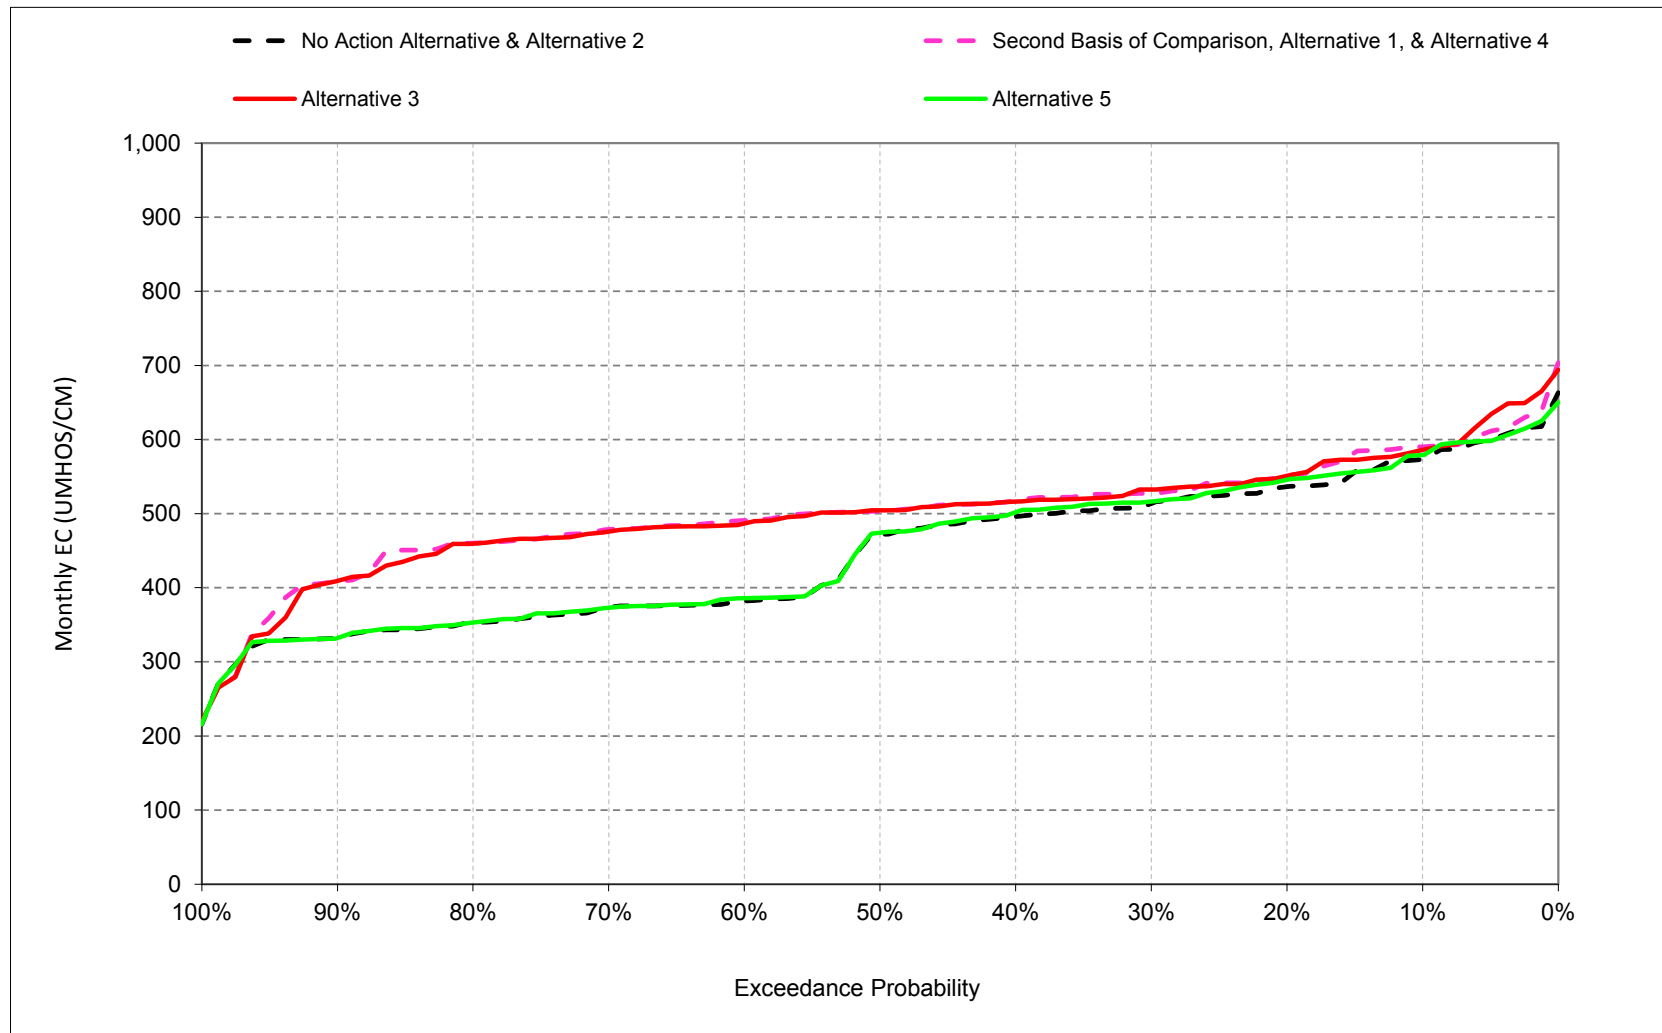


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.13.2. Contra Costa Victoria Canal Intake Salinity, Electrical Conductivity, November

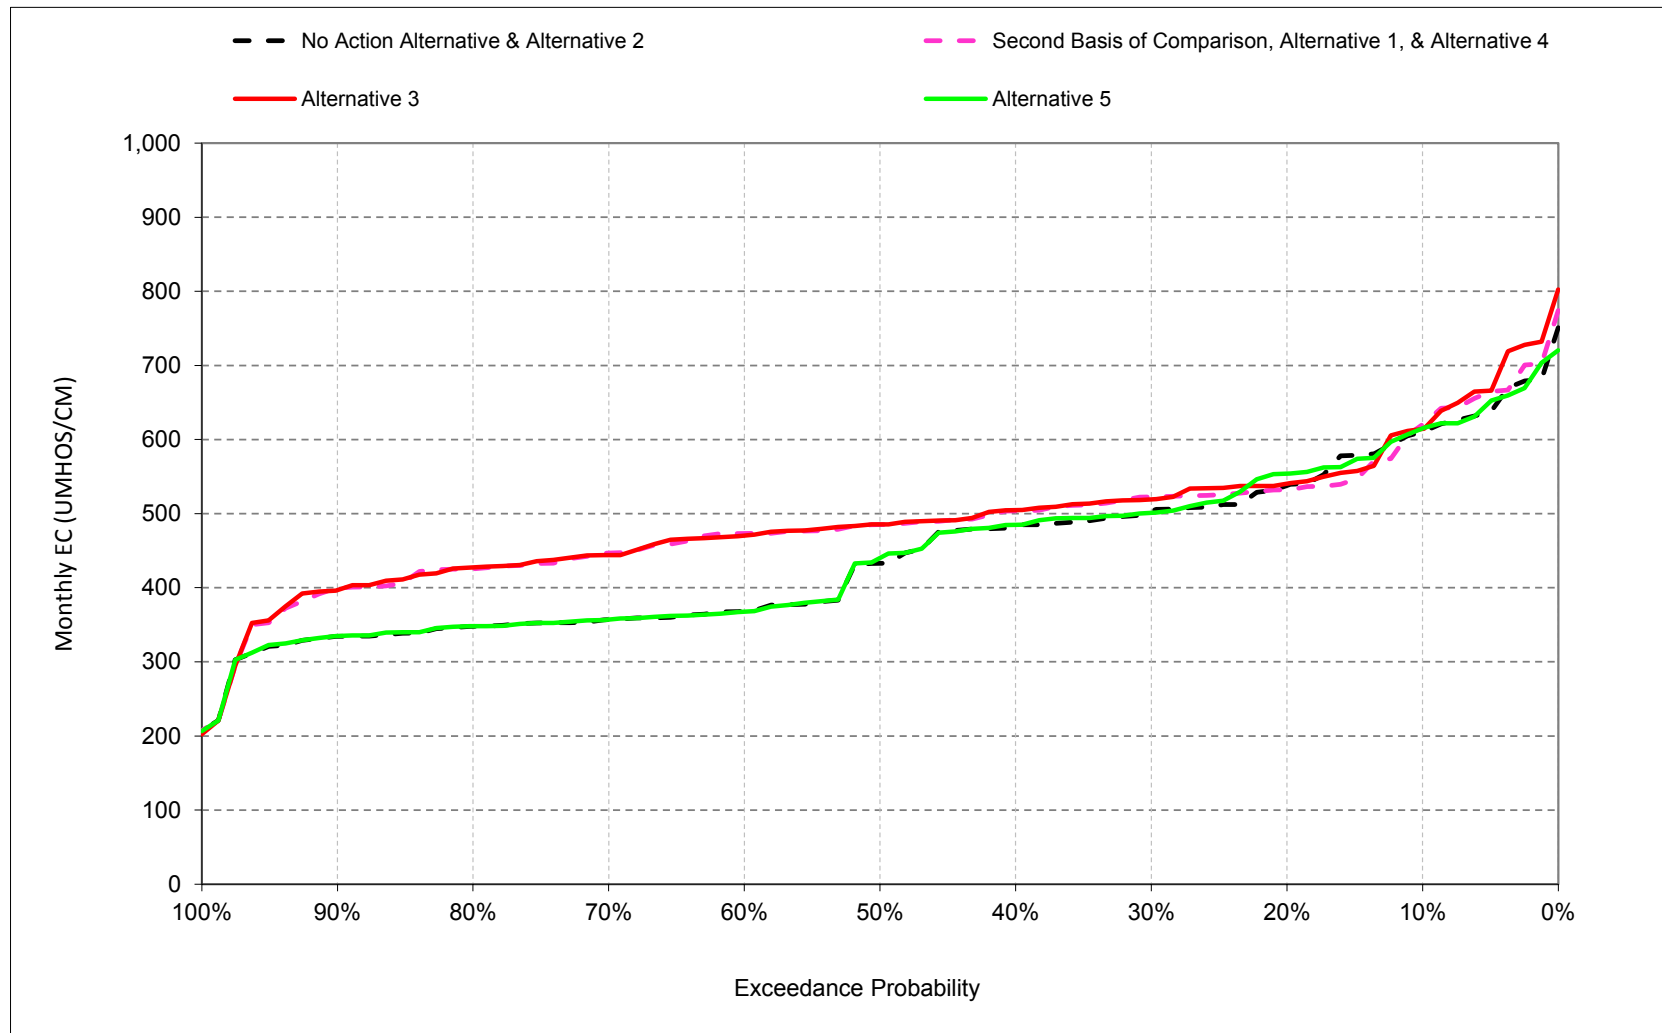


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.13.3. Contra Costa Victoria Canal Intake Salinity, Electrical Conductivity, December

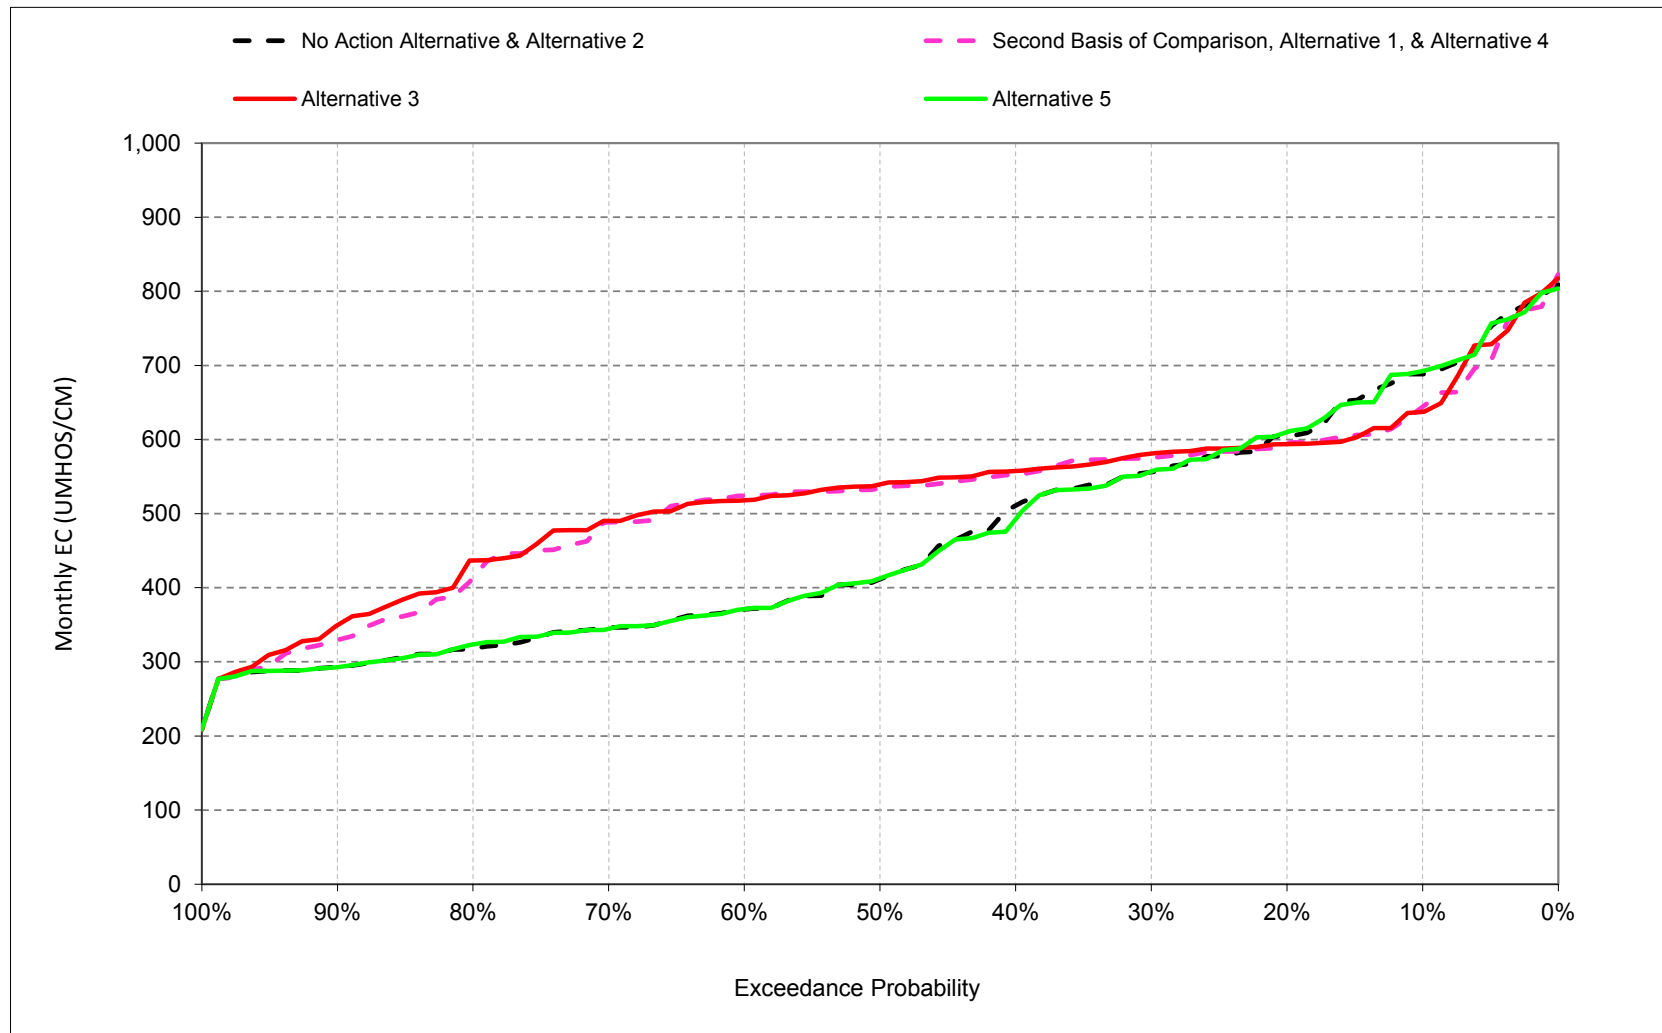


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.13.4. Contra Costa Victoria Canal Intake Salinity, Electrical Conductivity, January

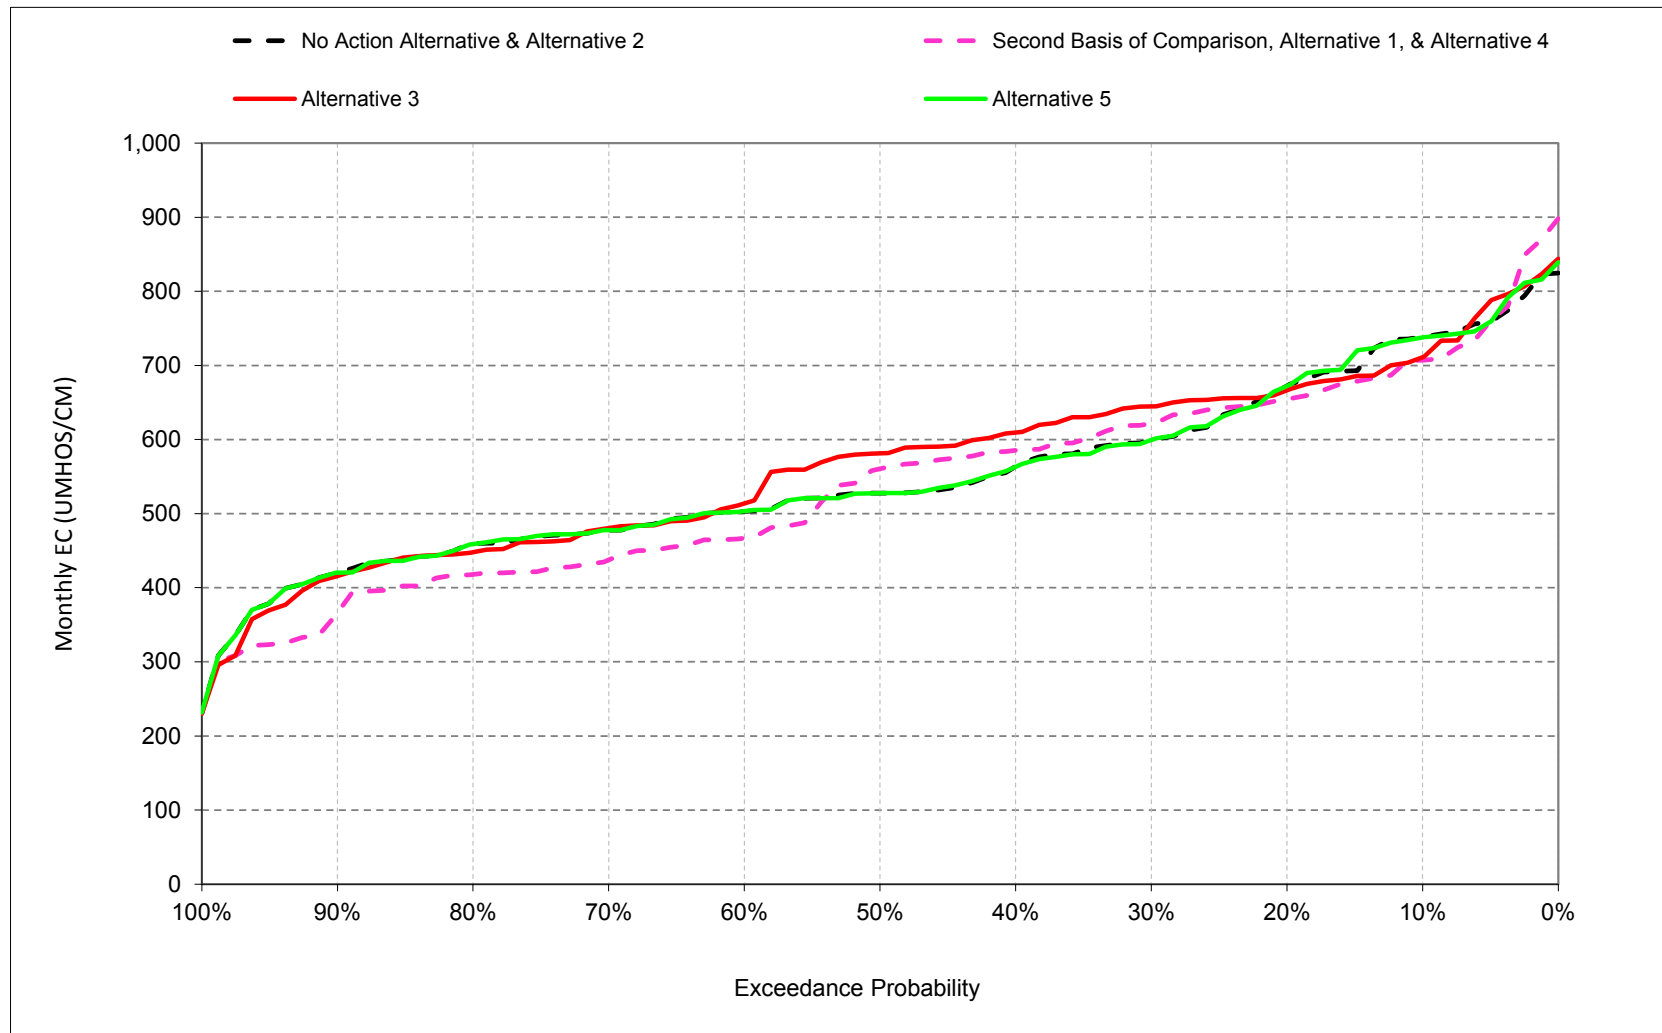


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.13.5. Contra Costa Victoria Canal Intake Salinity, Electrical Conductivity, February

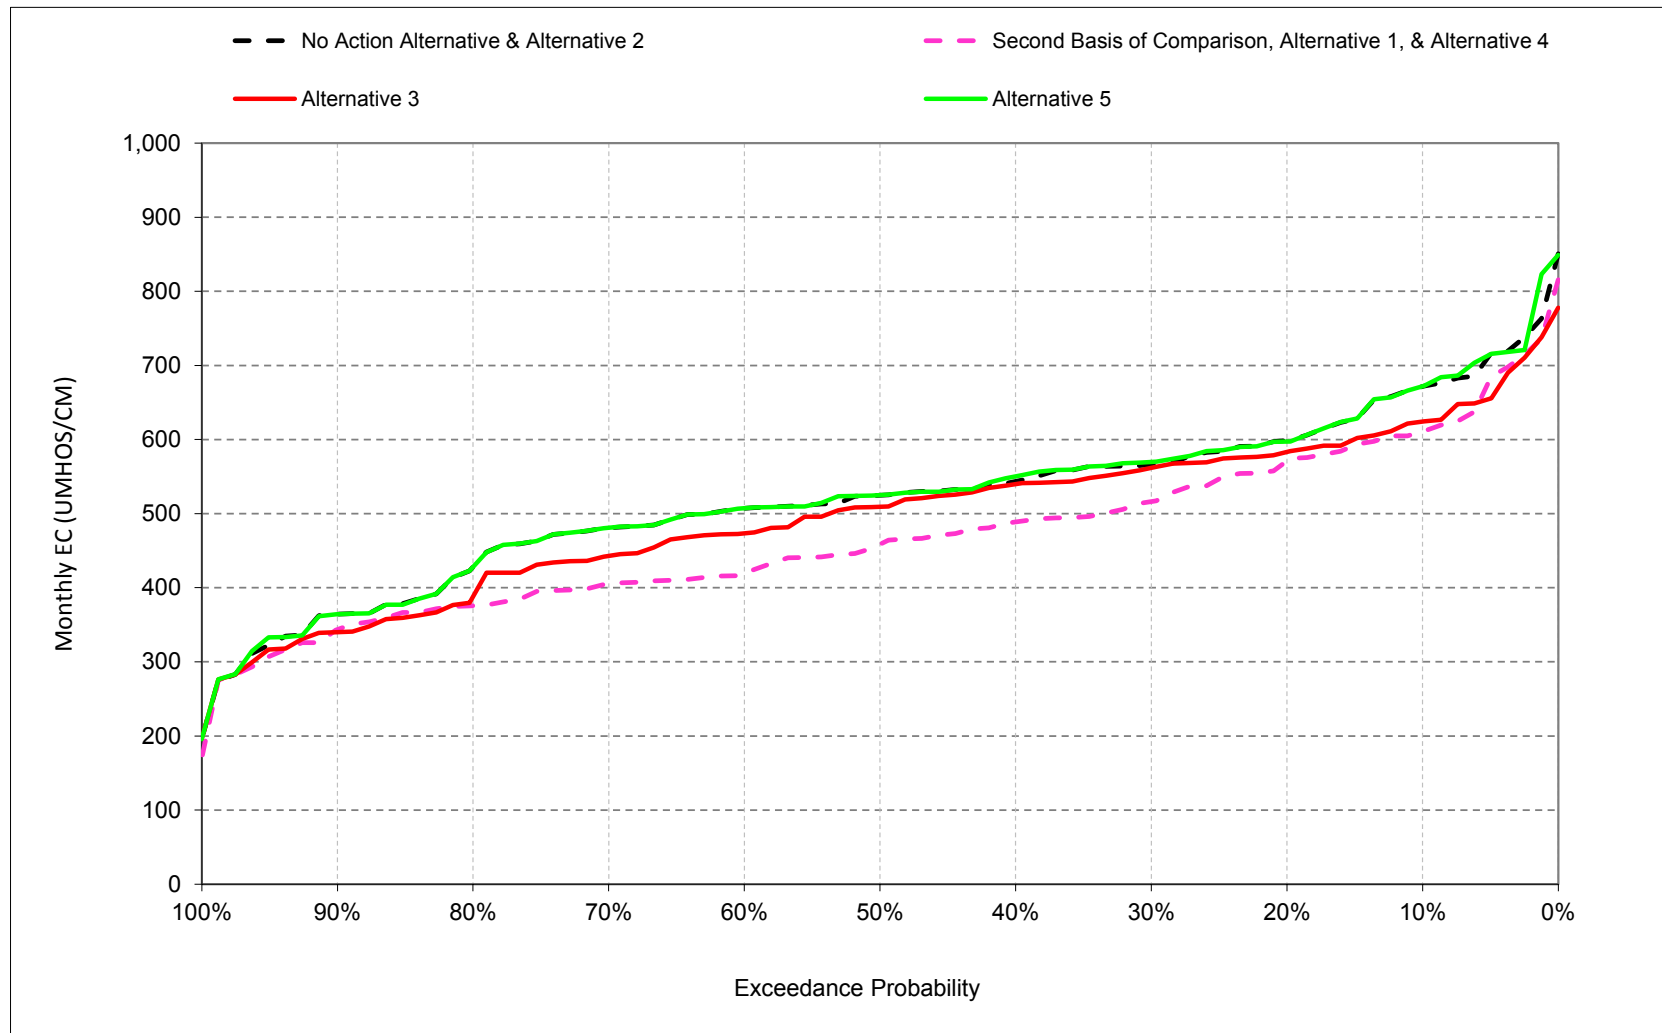


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.13.6. Contra Costa Victoria Canal Intake Salinity, Electrical Conductivity, March

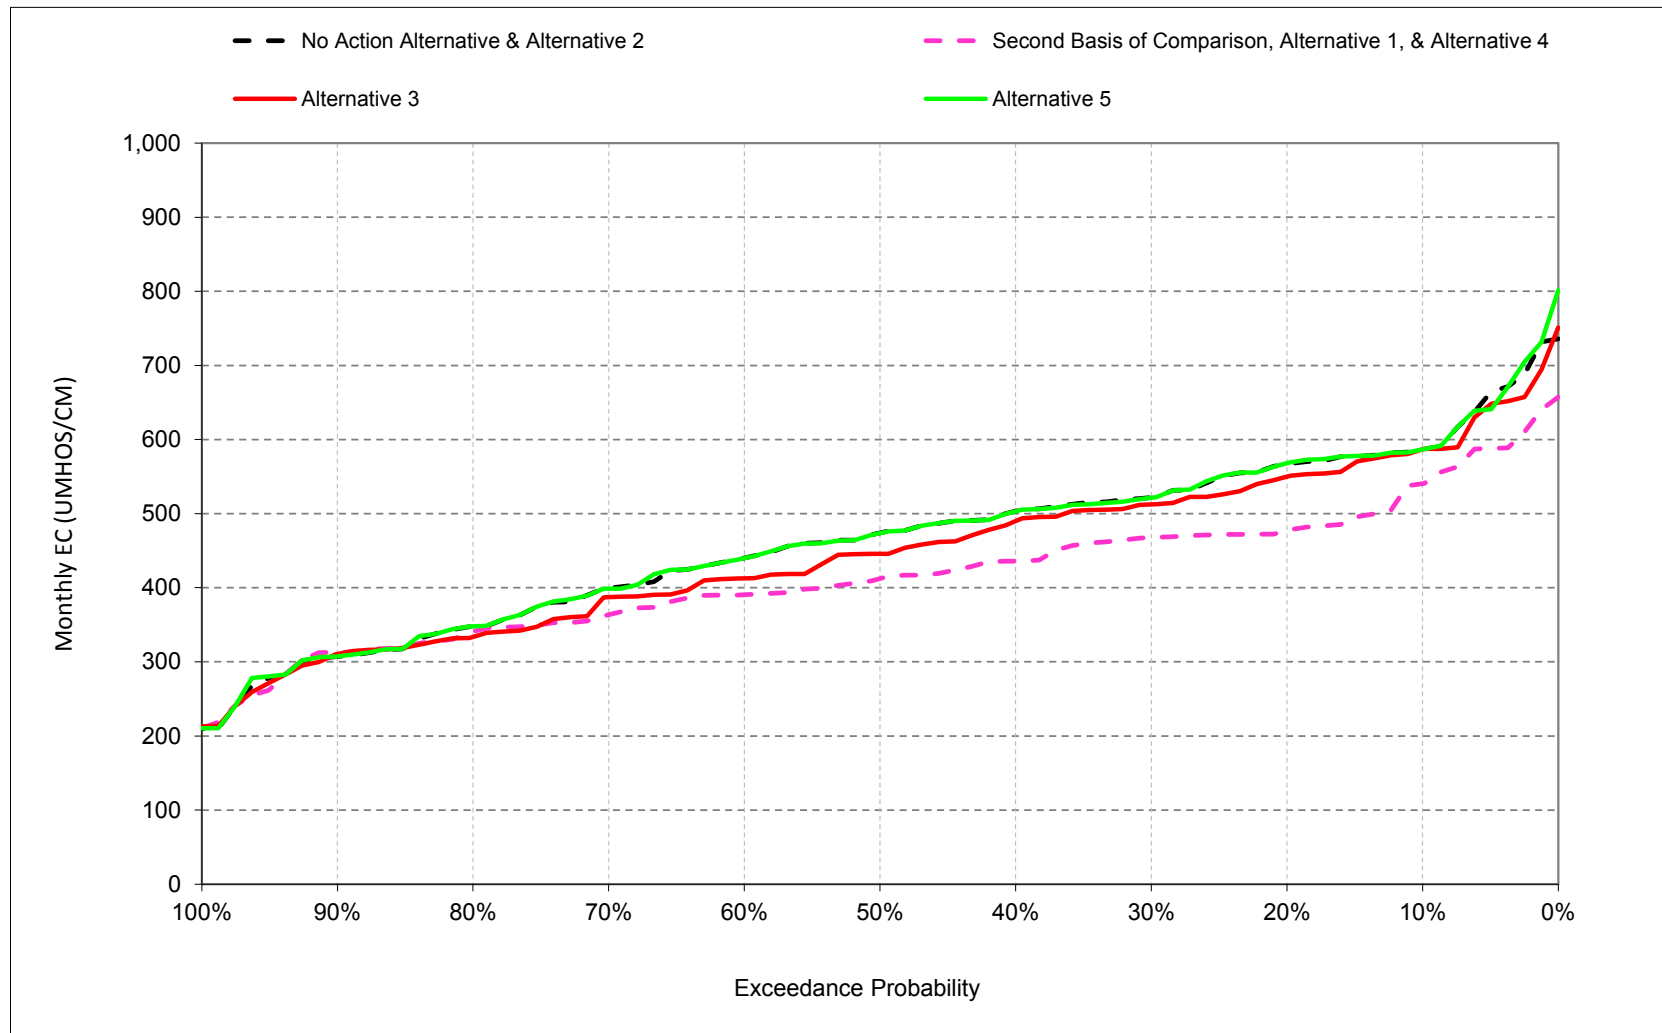


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.13.7. Contra Costa Victoria Canal Intake Salinity, Electrical Conductivity, April

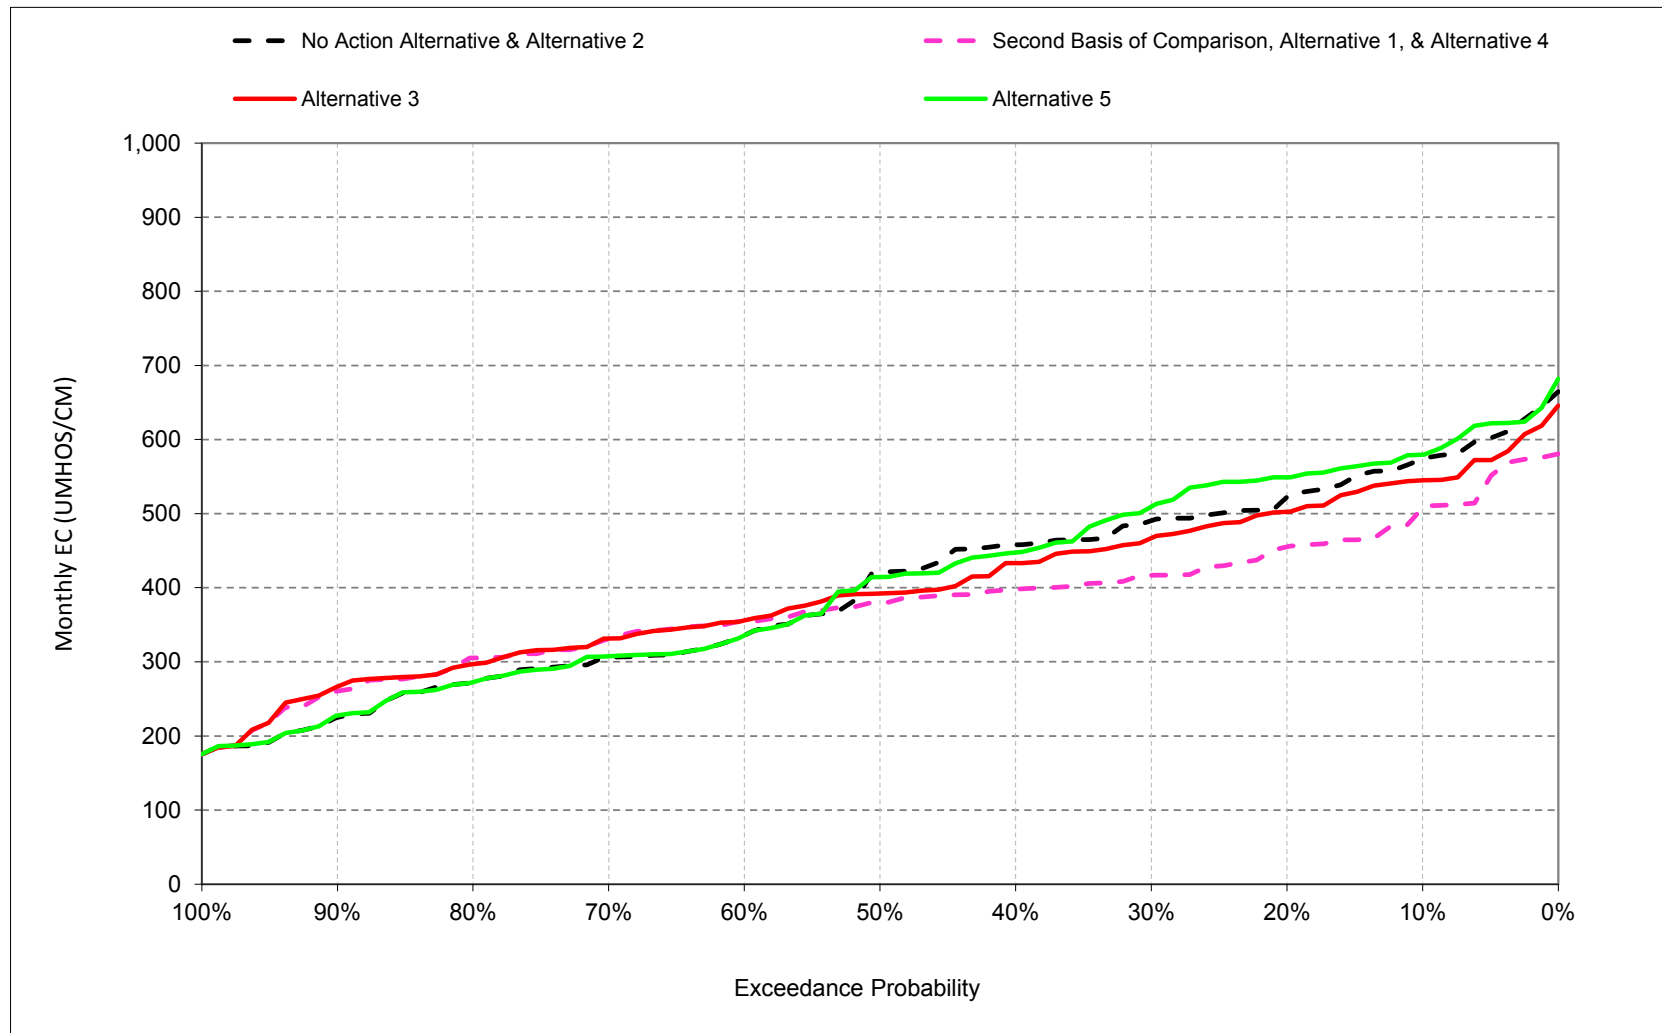


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.13.8. Contra Costa Victoria Canal Intake Salinity, Electrical Conductivity, May

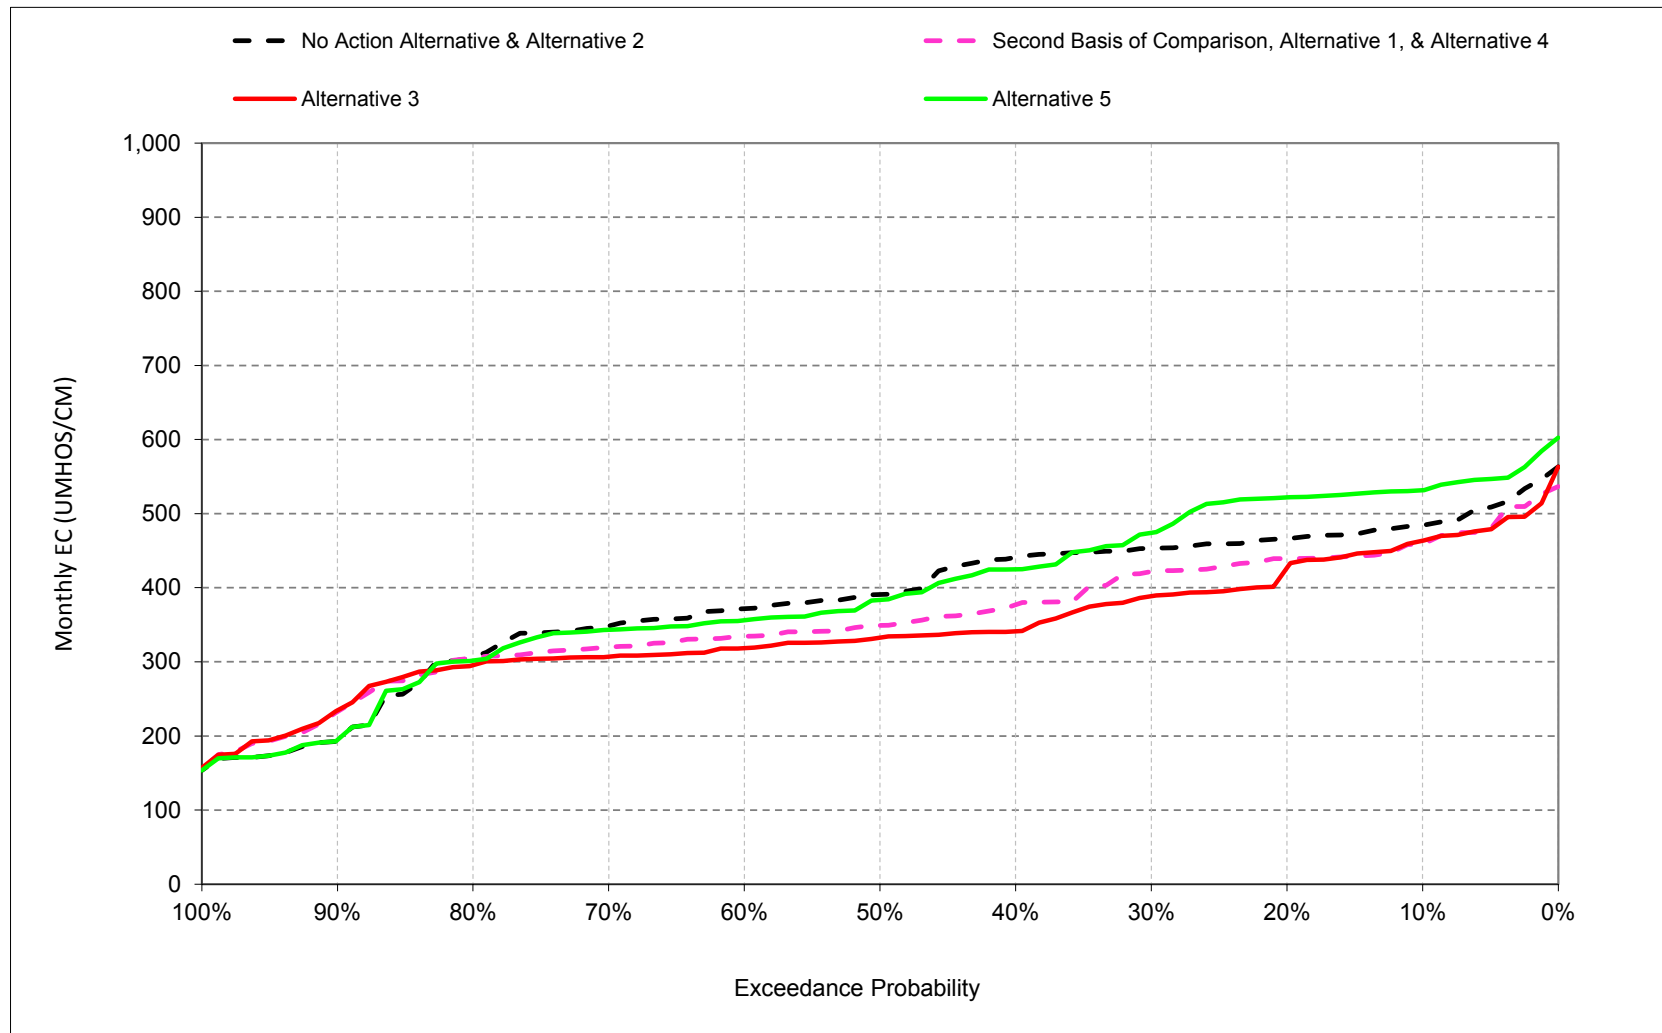


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.13.9. Contra Costa Victoria Canal Intake Salinity, Electrical Conductivity, June

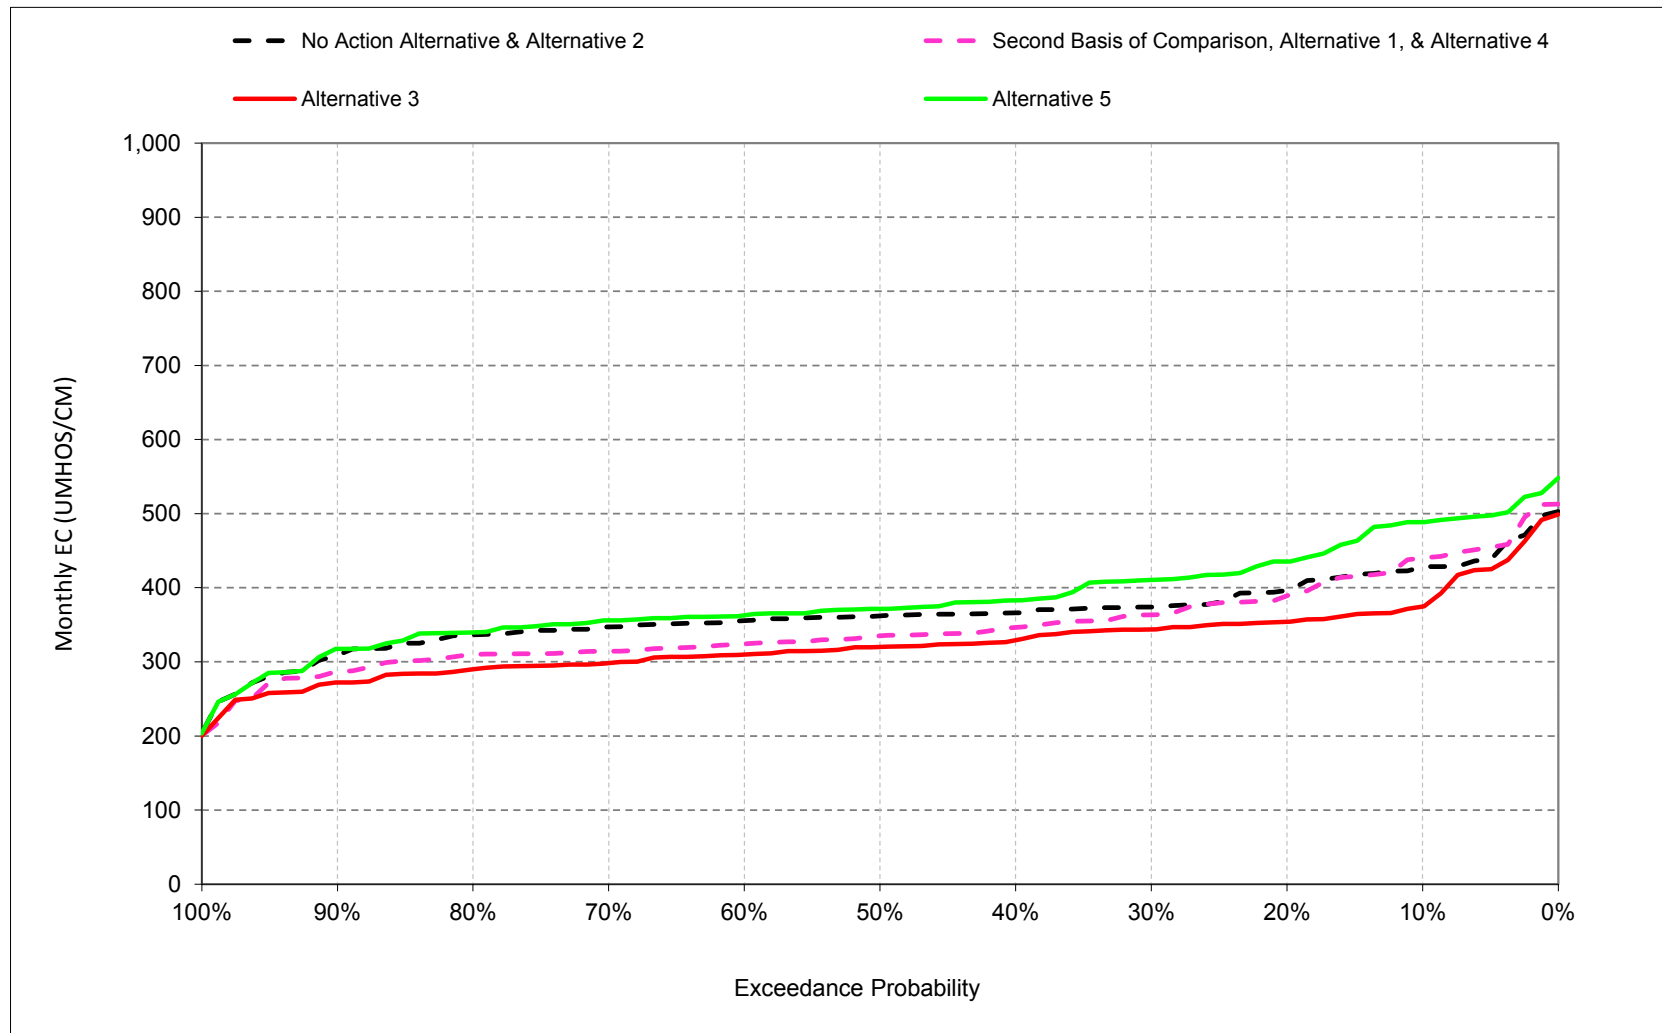


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.13.10. Contra Costa Victoria Canal Intake Salinity, Electrical Conductivity, July

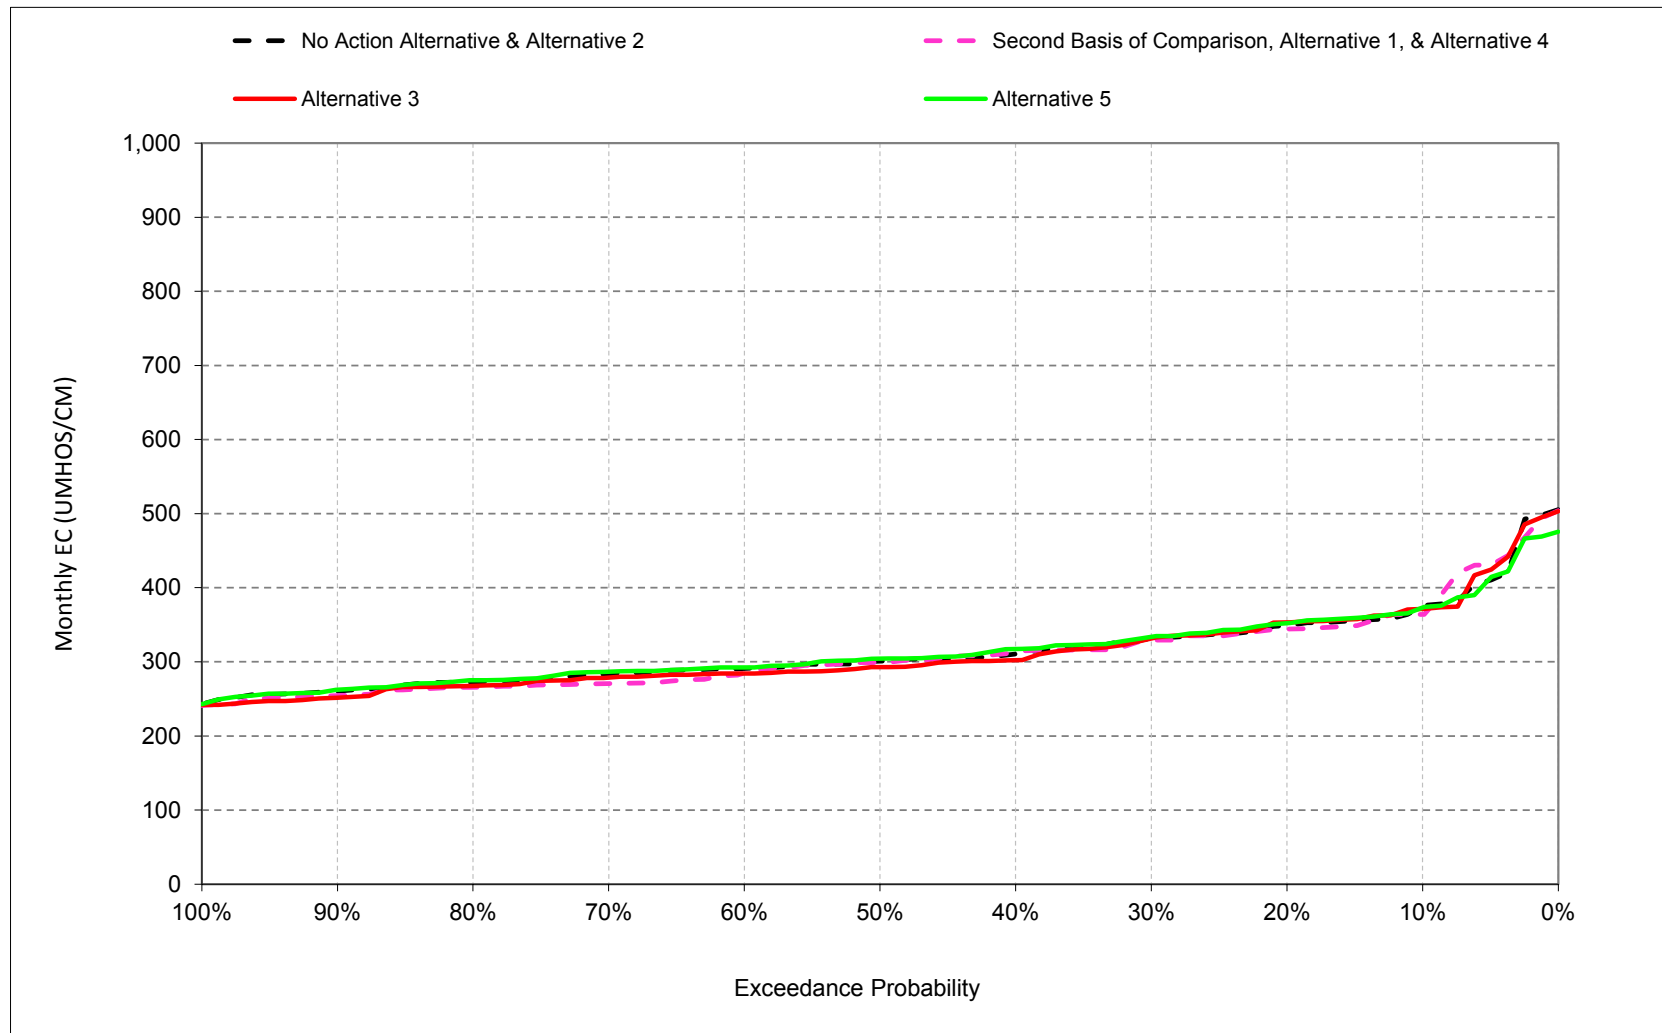


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.13.11. Contra Costa Victoria Canal Intake Salinity, Electrical Conductivity, August

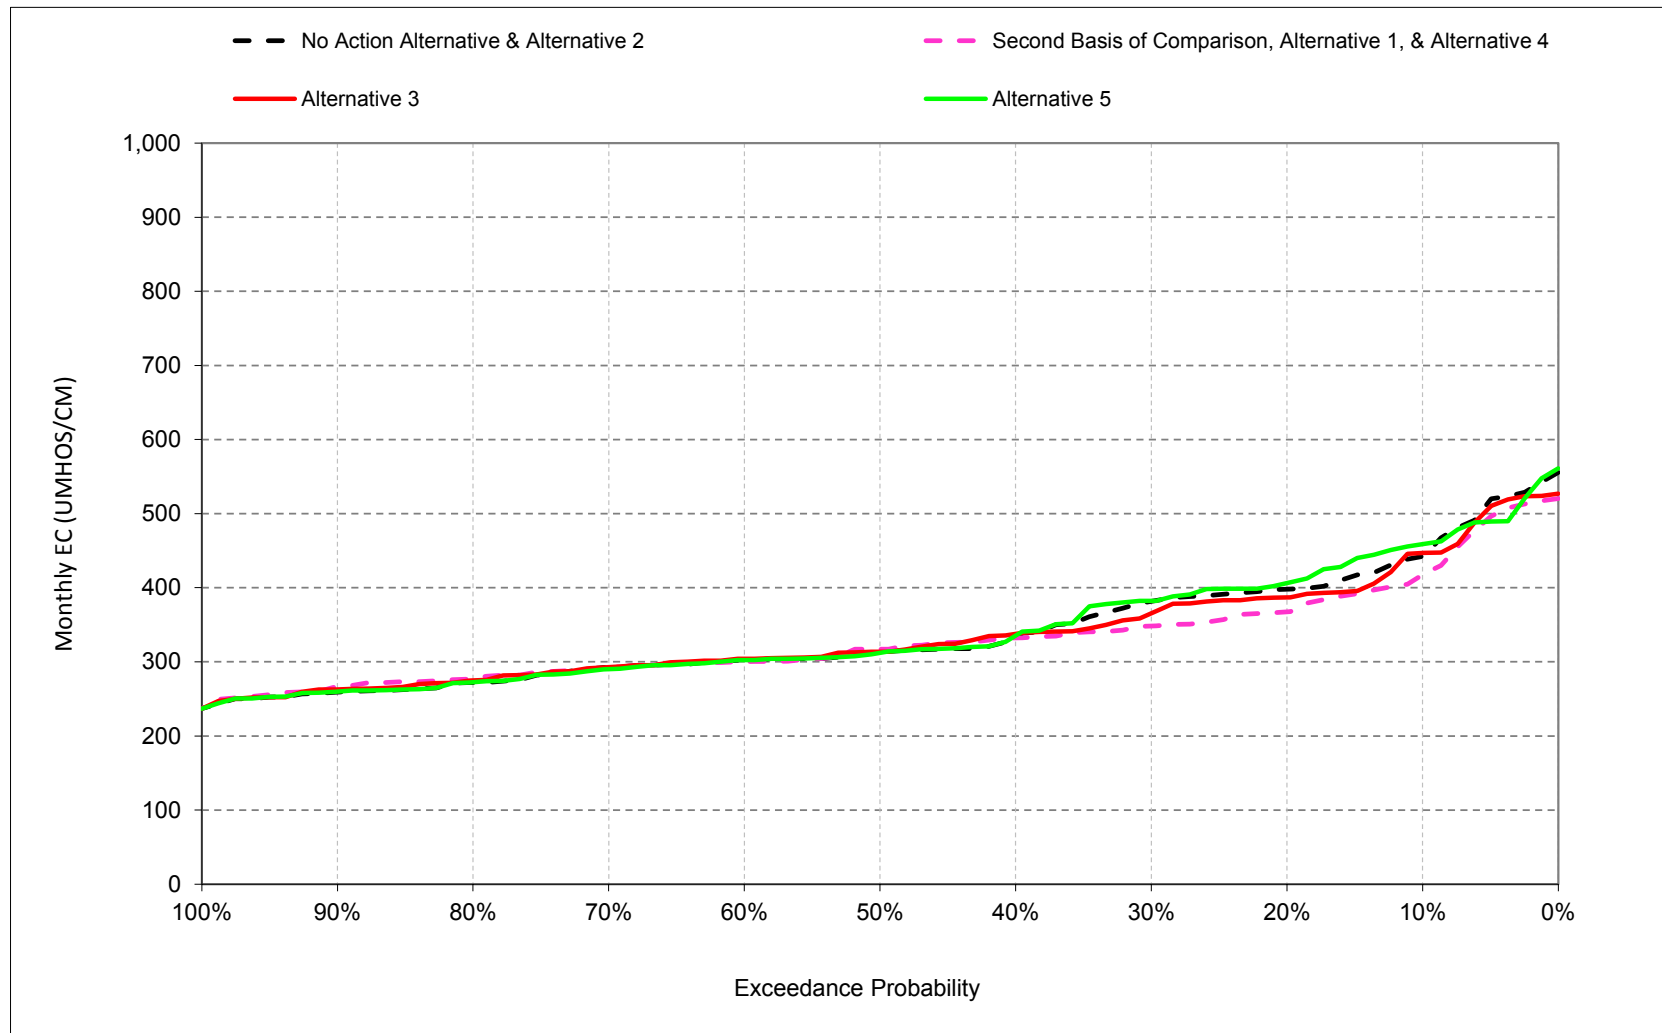

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.13.12. Contra Costa Victoria Canal Intake Salinity, Electrical Conductivity, September

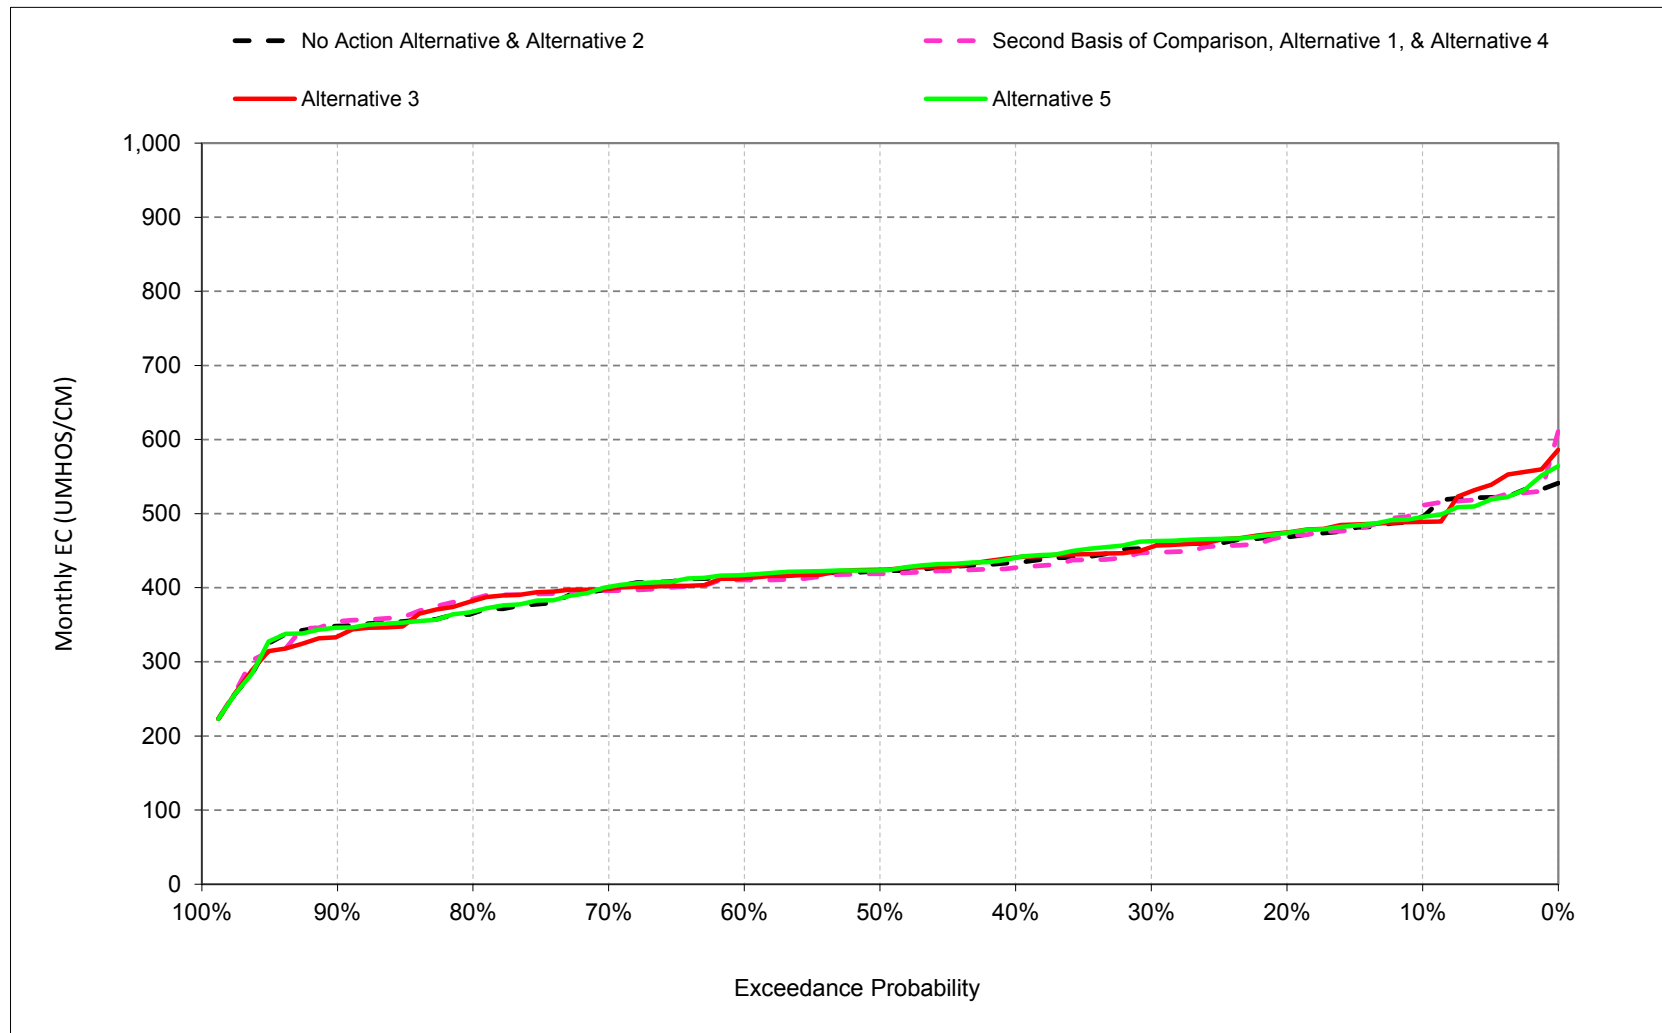

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.13.1. Contra Costa Victoria Canal Intake Salinity, Monthly EC

No Action Alternative

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	896	973	987	875	605	525	521	477	408	434	631	759
20%	843	802	857	767	554	451	461	449	364	368	563	722
30%	790	722	749	667	507	423	424	436	333	339	496	672
40%	754	680	618	571	464	387	402	408	323	325	437	633
50%	713	584	431	540	446	365	368	393	312	289	408	580
60%	337	330	366	486	422	348	324	375	310	277	366	555
70%	323	294	315	449	368	331	310	356	303	270	337	523
80%	314	274	291	385	354	311	279	308	288	264	324	474
90%	301	266	280	349	319	279	227	198	266	258	303	454
Long Term												
Full Simulation Period ^b	580	558	554	570	463	390	370	376	328	329	436	594
Water Year Types^c												
Wet (32%)	483	436	396	428	373	321	260	284	284	266	323	498
Above Normal (16%)	692	656	571	542	444	346	341	377	308	266	339	460
Below Normal (13%)	487	451	506	558	472	390	408	436	338	311	422	688
Dry (24%)	580	584	618	662	499	424	427	407	329	373	548	666
Critical (15%)	753	772	819	766	610	533	511	468	429	477	614	740

Alternative 1

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	901	968	1,010	914	687	494	407	386	397	427	595	755
20%	856	854	910	841	580	426	377	364	349	345	496	729
30%	830	804	884	773	490	385	335	338	308	328	468	697
40%	810	761	835	734	422	348	318	303	295	306	439	666
50%	789	733	775	656	396	332	301	288	283	291	393	648
60%	776	717	716	501	368	316	287	282	273	276	360	635
70%	743	691	658	386	356	294	280	274	265	265	328	624
80%	725	622	491	348	315	278	273	270	259	260	315	579
90%	661	487	321	310	283	263	242	257	250	254	300	530
Long Term												
Full Simulation Period ^b	769	729	734	614	445	356	322	310	304	320	419	646
Water Year Types^c												
Wet (32%)	706	674	583	407	339	314	266	254	267	265	313	555
Above Normal (16%)	828	750	720	598	392	314	293	278	267	261	339	654
Below Normal (13%)	722	665	736	685	541	374	333	311	275	305	425	656
Dry (24%)	785	749	825	725	487	354	338	339	313	343	493	687
Critical (15%)	855	854	923	829	575	480	436	416	431	481	603	761

Alternative 1 minus No Action Alternative

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	5	-5	23	39	81	-31	-114	-91	-11	-7	-36	-3
20%	13	52	54	74	26	-25	-83	-86	-15	-23	-67	7
30%	40	82	134	106	-17	-38	-89	-98	-25	-11	-28	25
40%	56	81	217	162	-43	-40	-84	-105	-28	-18	2	33
50%	77	149	344	116	-50	-33	-67	-104	-30	1	-14	68
60%	439	387	350	16	-54	-32	-37	-93	-37	-1	-6	80
70%	420	397	343	-63	-13	-38	-30	-83	-38	-6	-9	102
80%	411	348	200	-37	-39	-34	-6	-38	-29	-4	-9	105
90%	360	222	42	-40	-35	-16	15	59	-17	-4	-3	76
Long Term												
Full Simulation Period ^b	189	171	180	44	-18	-34	-49	-67	-24	-9	-18	53
Water Year Types^c												
Wet (32%)	223	237	187	-21	-34	-7	5	-31	-17	-1	-10	57
Above Normal (16%)	136	94	149	56	-52	-32	-49	-99	-41	-5	0	193
Below Normal (13%)	235	214	230	127	69	-16	-75	-125	-62	-6	2	-32
Dry (24%)	206	165	208	63	-11	-70	-89	-69	-16	-30	-54	21
Critical (15%)	102	82	104	63	-34	-53	-74	-52	2	4	-11	21

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.13.2. Contra Costa Victoria Canal Intake Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	896	973	987	875	605	525	521	477	408	434	631	759
20%	843	802	857	767	554	451	461	449	364	368	563	722
30%	790	722	749	667	507	423	424	436	333	339	496	672
40%	754	680	618	571	464	387	402	408	323	325	437	633
50%	713	584	431	540	446	365	368	393	312	289	408	580
60%	337	330	366	486	422	348	324	375	310	277	366	555
70%	323	294	315	449	368	331	310	356	303	270	337	523
80%	314	274	291	385	354	311	279	308	288	264	324	474
90%	301	266	280	349	319	279	227	198	266	258	303	454
Long Term												
Full Simulation Period ^b	580	558	554	570	463	390	370	376	328	329	436	594
Water Year Types^c												
Wet (32%)	483	436	396	428	373	321	260	284	284	266	323	498
Above Normal (16%)	692	656	571	542	444	346	341	377	308	266	339	460
Below Normal (13%)	487	451	506	558	472	390	408	436	338	311	422	688
Dry (24%)	580	584	618	662	499	424	427	407	329	373	548	666
Critical (15%)	753	772	819	766	610	533	511	468	429	477	614	740

Alternative 3												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	902	953	991	870	607	511	476	435	385	474	632	781
20%	862	864	922	821	552	438	416	375	313	360	543	729
30%	821	800	865	735	507	404	387	326	297	346	467	695
40%	806	750	827	696	473	382	360	305	284	320	445	676
50%	784	731	771	659	433	355	320	286	271	291	410	658
60%	758	714	728	511	402	330	300	277	261	276	362	637
70%	743	699	662	428	368	305	289	266	254	269	331	623
80%	720	646	501	395	338	289	281	258	250	262	313	576
90%	660	532	326	317	298	263	263	245	241	254	290	525
Long Term												
Full Simulation Period ^b	767	740	730	612	447	375	347	313	291	330	428	648
Water Year Types^c												
Wet (32%)	700	684	588	442	354	307	271	247	253	266	309	541
Above Normal (16%)	843	778	724	623	423	322	294	272	258	265	338	659
Below Normal (13%)	722	656	738	672	485	371	360	328	282	325	440	703
Dry (24%)	775	767	829	714	487	410	390	340	291	370	526	682
Critical (15%)	854	852	872	742	574	522	486	443	416	478	609	759

Alternative 3 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	6	-19	4	-4	2	-14	-45	-42	-23	40	1	22
20%	20	61	65	54	-3	-14	-44	-74	-50	-9	-20	7
30%	31	79	116	68	0	-18	-37	-109	-36	7	-29	23
40%	52	70	209	124	8	-5	-42	-103	-39	-5	8	43
50%	71	147	340	119	-13	-10	-49	-107	-42	2	3	78
60%	422	384	362	25	-20	-18	-24	-99	-49	-1	-4	82
70%	420	405	347	-22	0	-26	-21	-90	-49	-2	-6	100
80%	406	372	210	10	-16	-23	2	-50	-38	-3	-11	102
90%	359	266	47	-32	-20	-16	36	47	-25	-4	-13	71
Long Term												
Full Simulation Period ^b	187	182	176	42	-16	-16	-23	-63	-37	1	-8	54
Water Year Types^c												
Wet (32%)	217	247	192	14	-19	-14	11	-37	-32	-1	-13	43
Above Normal (16%)	151	123	154	81	-21	-24	-48	-105	-51	-2	-1	199
Below Normal (13%)	235	205	232	114	13	-19	-48	-108	-56	14	17	16
Dry (24%)	195	182	211	52	-12	-14	-37	-68	-38	-3	-22	16
Critical (15%)	101	81	53	-24	-36	-11	-25	-25	-14	1	-5	20

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
^b Based on the 82-year simulation period.
^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.13.3. Contra Costa Victoria Canal Intake Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	896	973	987	875	605	525	521	477	408	434	631	759
20%	843	802	857	767	554	451	461	449	364	368	563	722
30%	790	722	749	667	507	423	424	436	333	339	496	672
40%	754	680	618	571	464	387	402	408	323	325	437	633
50%	713	584	431	540	446	365	368	393	312	289	408	580
60%	337	330	366	486	422	348	324	375	310	277	366	555
70%	323	294	315	449	368	331	310	356	303	270	337	523
80%	314	274	291	385	354	311	279	308	288	264	324	474
90%	301	266	280	349	319	279	227	198	266	258	303	454
Long Term												
Full Simulation Period ^b	580	558	554	570	463	390	370	376	328	329	436	594
Water Year Types ^c												
Wet (32%)	483	436	396	428	373	321	260	284	284	266	323	498
Above Normal (16%)	692	656	571	542	444	346	341	377	308	266	339	460
Below Normal (13%)	487	451	506	558	472	390	408	436	338	311	422	688
Dry (24%)	580	584	618	662	499	424	427	407	329	373	548	666
Critical (15%)	753	772	819	766	610	533	511	468	429	477	614	740

Alternative 5												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	912	970	977	879	606	522	555	542	475	446	631	763
20%	853	827	843	781	555	454	520	533	392	376	588	729
30%	801	734	750	674	496	423	460	488	370	350	517	686
40%	766	671	628	571	465	385	407	438	342	330	442	656
50%	709	595	426	540	446	365	375	393	326	290	408	588
60%	340	328	377	484	423	349	323	366	313	277	362	559
70%	324	288	314	449	382	331	310	355	309	271	339	531
80%	314	276	291	385	353	311	275	308	297	263	325	482
90%	301	266	280	350	318	279	228	198	266	259	299	443
Long Term												
Full Simulation Period ^b	584	560	555	572	465	391	386	401	348	332	444	600
Water Year Types ^c												
Wet (32%)	485	443	403	428	376	321	261	278	286	266	322	496
Above Normal (16%)	706	654	563	540	444	346	338	364	313	267	338	459
Below Normal (13%)	486	453	506	557	470	388	398	435	357	315	423	695
Dry (24%)	585	582	615	671	502	425	464	480	372	388	574	685
Critical (15%)	756	772	818	766	617	540	568	546	475	468	623	752

Alternative 5 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	16	-3	-10	5	0	-3	34	65	67	12	-1	4
20%	10	25	-14	14	1	3	60	83	28	7	25	7
30%	11	12	1	6	-11	0	36	52	37	11	21	14
40%	12	-8	10	0	1	-2	5	30	19	5	4	23
50%	-4	11	-5	0	0	0	7	1	14	1	1	8
60%	3	-2	10	-1	1	1	-1	-9	3	0	-3	5
70%	1	-6	-1	0	13	0	0	-2	5	1	2	8
80%	-1	2	0	0	-1	0	-4	0	9	-1	1	8
90%	0	0	0	0	-1	1	1	0	0	1	-4	-11
Long Term												
Full Simulation Period ^b	4	2	0	2	2	1	16	25	21	3	8	7
Water Year Types ^c												
Wet (32%)	1	7	8	0	2	0	0	-6	1	0	0	-2
Above Normal (16%)	14	-1	-8	-2	0	0	-3	-12	5	1	-1	-1
Below Normal (13%)	-1	3	0	-1	-2	-2	-10	-1	20	4	1	8
Dry (24%)	5	-3	-3	9	3	1	37	72	42	15	27	19
Critical (15%)	3	0	-1	0	7	7	58	78	46	-8	9	12

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
^b Based on the 82-year simulation period.
^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.13.4. Contra Costa Victoria Canal Intake Salinity, Monthly EC

Second Basis of Comparison		Monthly EC (UMHOS/CM)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
10%	901	968	1,010	914	687	494	407	386	397	427	595	755	
20%	856	854	910	841	580	426	377	364	349	345	496	729	
30%	830	804	884	773	490	385	335	338	308	328	468	697	
40%	810	761	835	734	422	348	318	303	295	306	439	666	
50%	789	733	775	656	396	332	301	288	283	291	393	648	
60%	776	717	716	501	368	316	287	282	273	276	360	635	
70%	743	691	658	386	356	294	280	274	265	265	328	624	
80%	725	622	491	348	315	278	273	270	259	260	315	579	
90%	661	487	321	310	283	263	242	257	250	254	300	530	
Long Term													
Full Simulation Period ^b	769	729	734	614	445	356	322	310	304	320	419	646	
Water Year Types ^c													
Wet (32%)	706	674	583	407	339	314	266	254	267	265	313	555	
Above Normal (16%)	828	750	720	598	392	314	293	278	267	261	339	654	
Below Normal (13%)	722	665	736	685	541	374	333	311	275	305	425	656	
Dry (24%)	785	749	825	725	487	354	338	339	313	343	493	687	
Critical (15%)	855	854	923	829	575	480	436	416	431	481	603	761	

No Action Alternative		Monthly EC (UMHOS/CM)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
10%	896	973	987	875	605	525	521	477	408	434	631	759	
20%	843	802	857	767	554	451	461	449	364	368	563	722	
30%	790	722	749	667	507	423	424	436	333	339	496	672	
40%	754	680	618	571	464	387	402	408	323	325	437	633	
50%	713	584	431	540	446	365	368	393	312	289	408	580	
60%	337	330	366	486	422	348	324	375	310	277	366	555	
70%	323	294	315	449	368	331	310	356	303	270	337	523	
80%	314	274	291	385	354	311	279	308	288	264	324	474	
90%	301	266	280	349	319	279	227	198	266	258	303	454	
Long Term													
Full Simulation Period ^b	580	558	554	570	463	390	370	376	328	329	436	594	
Water Year Types ^c													
Wet (32%)	483	436	396	428	373	321	260	284	284	266	323	498	
Above Normal (16%)	692	656	571	542	444	346	341	377	308	266	339	460	
Below Normal (13%)	487	451	506	558	472	390	408	436	338	311	422	688	
Dry (24%)	580	584	618	662	499	424	427	407	329	373	548	666	
Critical (15%)	753	772	819	766	610	533	511	468	429	477	614	740	

No Action Alternative minus Second Basis of Comparison		Monthly EC (UMHOS/CM)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
10%	-5	5	-23	-39	-81	31	114	91	11	7	36	3	
20%	-13	-52	-54	-74	-26	25	83	86	15	23	67	-7	
30%	-40	-82	-134	-106	17	38	89	98	25	11	28	-25	
40%	-56	-81	-217	-162	43	40	84	105	28	18	-2	-33	
50%	-77	-149	-344	-116	50	33	67	104	30	-1	14	-68	
60%	-439	-387	-350	-16	54	32	37	93	37	1	6	-80	
70%	-420	-397	-343	63	13	38	30	83	38	6	9	-102	
80%	-411	-348	-200	37	39	34	6	38	29	4	9	-105	
90%	-360	-222	-42	40	35	16	-15	-59	17	4	3	-76	
Long Term													
Full Simulation Period ^b	-189	-171	-180	-44	18	34	49	67	24	9	18	-53	
Water Year Types ^c													
Wet (32%)	-223	-237	-187	21	34	7	-5	31	17	1	10	-57	
Above Normal (16%)	-136	-94	-149	-56	52	32	49	99	41	5	0	-193	
Below Normal (13%)	-235	-214	-230	-127	-69	16	75	125	62	6	-2	32	
Dry (24%)	-206	-165	-208	-63	11	70	89	69	16	30	54	-21	
Critical (15%)	-102	-82	-104	-63	34	53	74	52	-2	-4	11	-21	

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.13.5. Contra Costa Victoria Canal Intake Salinity, Monthly EC

Second Basis of Comparison												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	901	968	1,010	914	687	494	407	386	397	427	595	755
20%	856	854	910	841	580	426	377	364	349	345	496	729
30%	830	804	884	773	490	385	335	338	308	328	468	697
40%	810	761	835	734	422	348	318	303	295	306	439	666
50%	789	733	775	656	396	332	301	288	283	291	393	648
60%	776	717	716	501	368	316	287	282	273	276	360	635
70%	743	691	658	386	356	294	280	274	265	265	328	624
80%	725	622	491	348	315	278	273	270	259	260	315	579
90%	661	487	321	310	283	263	242	257	250	254	300	530
Long Term												
Full Simulation Period ^b	769	729	734	614	445	356	322	310	304	320	419	646
Water Year Types ^c												
Wet (32%)	706	674	583	407	339	314	266	254	267	265	313	555
Above Normal (16%)	828	750	720	598	392	314	293	278	267	261	339	654
Below Normal (13%)	722	665	736	685	541	374	333	311	275	305	425	656
Dry (24%)	785	749	825	725	487	354	338	339	313	343	493	687
Critical (15%)	855	854	923	829	575	480	436	416	431	481	603	761

Alternative 3												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	902	953	991	870	607	511	476	435	385	474	632	781
20%	862	864	922	821	552	438	416	375	313	360	543	729
30%	821	800	865	735	507	404	387	326	297	346	467	695
40%	806	750	827	696	473	382	360	305	284	320	445	676
50%	784	731	771	659	433	355	320	286	271	291	410	658
60%	758	714	728	511	402	330	300	277	261	276	362	637
70%	743	699	662	428	368	305	289	266	254	269	331	623
80%	720	646	501	395	338	289	281	258	250	262	313	576
90%	660	532	326	317	298	263	263	245	241	254	290	525
Long Term												
Full Simulation Period ^b	767	740	730	612	447	375	347	313	291	330	428	648
Water Year Types ^c												
Wet (32%)	700	684	588	442	354	307	271	247	253	266	309	541
Above Normal (16%)	843	778	724	623	423	322	294	272	258	265	338	659
Below Normal (13%)	722	656	738	672	485	371	360	328	282	325	440	703
Dry (24%)	775	767	829	714	487	410	390	340	291	370	526	682
Critical (15%)	854	852	872	742	574	522	486	443	416	478	609	759

Alternative 3 minus Second Basis of Comparison												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1	-15	-19	-44	-79	17	69	49	-13	47	37	25
20%	6	10	12	-21	-29	11	39	11	-36	14	47	-1
30%	-9	-3	-19	-38	17	20	52	-12	-11	17	-1	-2
40%	-4	-10	-8	-38	51	34	42	2	-12	14	6	11
50%	-5	-2	-4	3	37	23	19	-3	-12	0	17	10
60%	-17	-3	12	10	34	14	13	-5	-12	0	2	2
70%	0	8	4	42	13	12	9	-8	-11	4	3	-1
80%	-5	24	10	47	23	11	8	-12	-8	2	-2	-3
90%	-1	45	5	7	15	0	21	-12	-8	0	-10	-5
Long Term												
Full Simulation Period ^b	-2	11	-4	-2	2	19	25	3	-13	10	10	2
Water Year Types ^c												
Wet (32%)	-6	10	5	35	15	-7	5	-7	-15	1	-4	-14
Above Normal (16%)	15	28	5	25	31	9	1	-6	-10	3	-1	5
Below Normal (13%)	0	-9	2	-13	-56	-3	28	16	6	20	15	48
Dry (24%)	-10	17	4	-11	-1	56	52	1	-22	27	33	-5
Critical (15%)	-1	-1	-51	-87	-1	42	49	27	-16	-3	6	-1

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.13.6. Contra Costa Victoria Canal Intake Salinity, Monthly EC

Second Basis of Comparison		Monthly EC (UMHOS/CM)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
10%	901	968	1,010	914	687	494	407	386	397	427	595	755	
20%	856	854	910	841	580	426	377	364	349	345	496	729	
30%	830	804	884	773	490	385	335	338	308	328	468	697	
40%	810	761	835	734	422	348	318	303	295	306	439	666	
50%	789	733	775	656	396	332	301	288	283	291	393	648	
60%	776	717	716	501	368	316	287	282	273	276	360	635	
70%	743	691	658	386	356	294	280	274	265	265	328	624	
80%	725	622	491	348	315	278	273	270	259	260	315	579	
90%	661	487	321	310	283	263	242	257	250	254	300	530	
Long Term													
Full Simulation Period ^b	769	729	734	614	445	356	322	310	304	320	419	646	
Water Year Types ^c													
Wet (32%)	706	674	583	407	339	314	266	254	267	265	313	555	
Above Normal (16%)	828	750	720	598	392	314	293	278	267	261	339	654	
Below Normal (13%)	722	665	736	685	541	374	333	311	275	305	425	656	
Dry (24%)	785	749	825	725	487	354	338	339	313	343	493	687	
Critical (15%)	855	854	923	829	575	480	436	416	431	481	603	761	

Alternative 5		Monthly EC (UMHOS/CM)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
10%	912	970	977	879	606	522	555	542	475	446	631	763	
20%	853	827	843	781	555	454	520	533	392	376	588	729	
30%	801	734	750	674	496	423	460	488	370	350	517	686	
40%	766	671	628	571	465	385	407	438	342	330	442	656	
50%	709	595	426	540	446	365	375	393	326	290	408	588	
60%	340	328	377	484	423	349	323	366	313	277	362	559	
70%	324	288	314	449	382	331	310	355	309	271	339	531	
80%	314	276	291	385	353	311	275	308	297	263	325	482	
90%	301	266	280	350	318	279	228	198	266	259	299	443	
Long Term													
Full Simulation Period ^b	584	560	555	572	465	391	386	401	348	332	444	600	
Water Year Types ^c													
Wet (32%)	485	443	403	428	376	321	261	278	286	266	322	496	
Above Normal (16%)	706	654	563	540	444	346	338	364	313	267	338	459	
Below Normal (13%)	486	453	506	557	470	388	398	435	357	315	423	695	
Dry (24%)	585	582	615	671	502	425	464	480	372	388	574	685	
Critical (15%)	756	772	818	766	617	540	568	546	475	468	623	752	

Alternative 5 minus Second Basis of Comparison		Monthly EC (UMHOS/CM)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
10%	11	2	-33	-35	-81	29	148	156	77	19	36	7	
20%	-3	-27	-67	-60	-25	28	143	169	43	30	91	0	
30%	-29	-70	-134	-99	7	38	125	150	63	21	49	-11	
40%	-44	-89	-207	-163	44	37	89	135	47	24	2	-10	
50%	-80	-139	-349	-116	50	33	74	105	43	-1	15	-61	
60%	-436	-389	-339	-17	55	32	36	84	40	1	3	-76	
70%	-420	-403	-344	63	26	38	30	81	43	7	11	-94	
80%	-412	-347	-200	37	38	34	2	38	38	4	10	-97	
90%	-360	-221	-42	40	35	16	-14	-59	17	5	-1	-87	
Long Term													
Full Simulation Period ^b	-184	-169	-179	-42	20	35	64	91	45	12	25	-46	
Water Year Types ^c													
Wet (32%)	-221	-230	-179	22	37	7	-5	25	18	2	9	-59	
Above Normal (16%)	-122	-96	-157	-58	52	32	46	86	46	6	-1	-195	
Below Normal (13%)	-236	-211	-231	-127	-71	14	65	123	82	10	-2	40	
Dry (24%)	-200	-167	-211	-54	15	71	126	141	58	45	81	-2	
Critical (15%)	-98	-82	-105	-63	41	60	132	130	44	-13	20	-9	

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.


^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1
2


B.14. Barker Slough North Bay Aqueduct Intake Salinity

Figure 6E.B.14.1. Barker Slough North Bay Aqueduct Intake Salinity, Electrical Conductivity, October

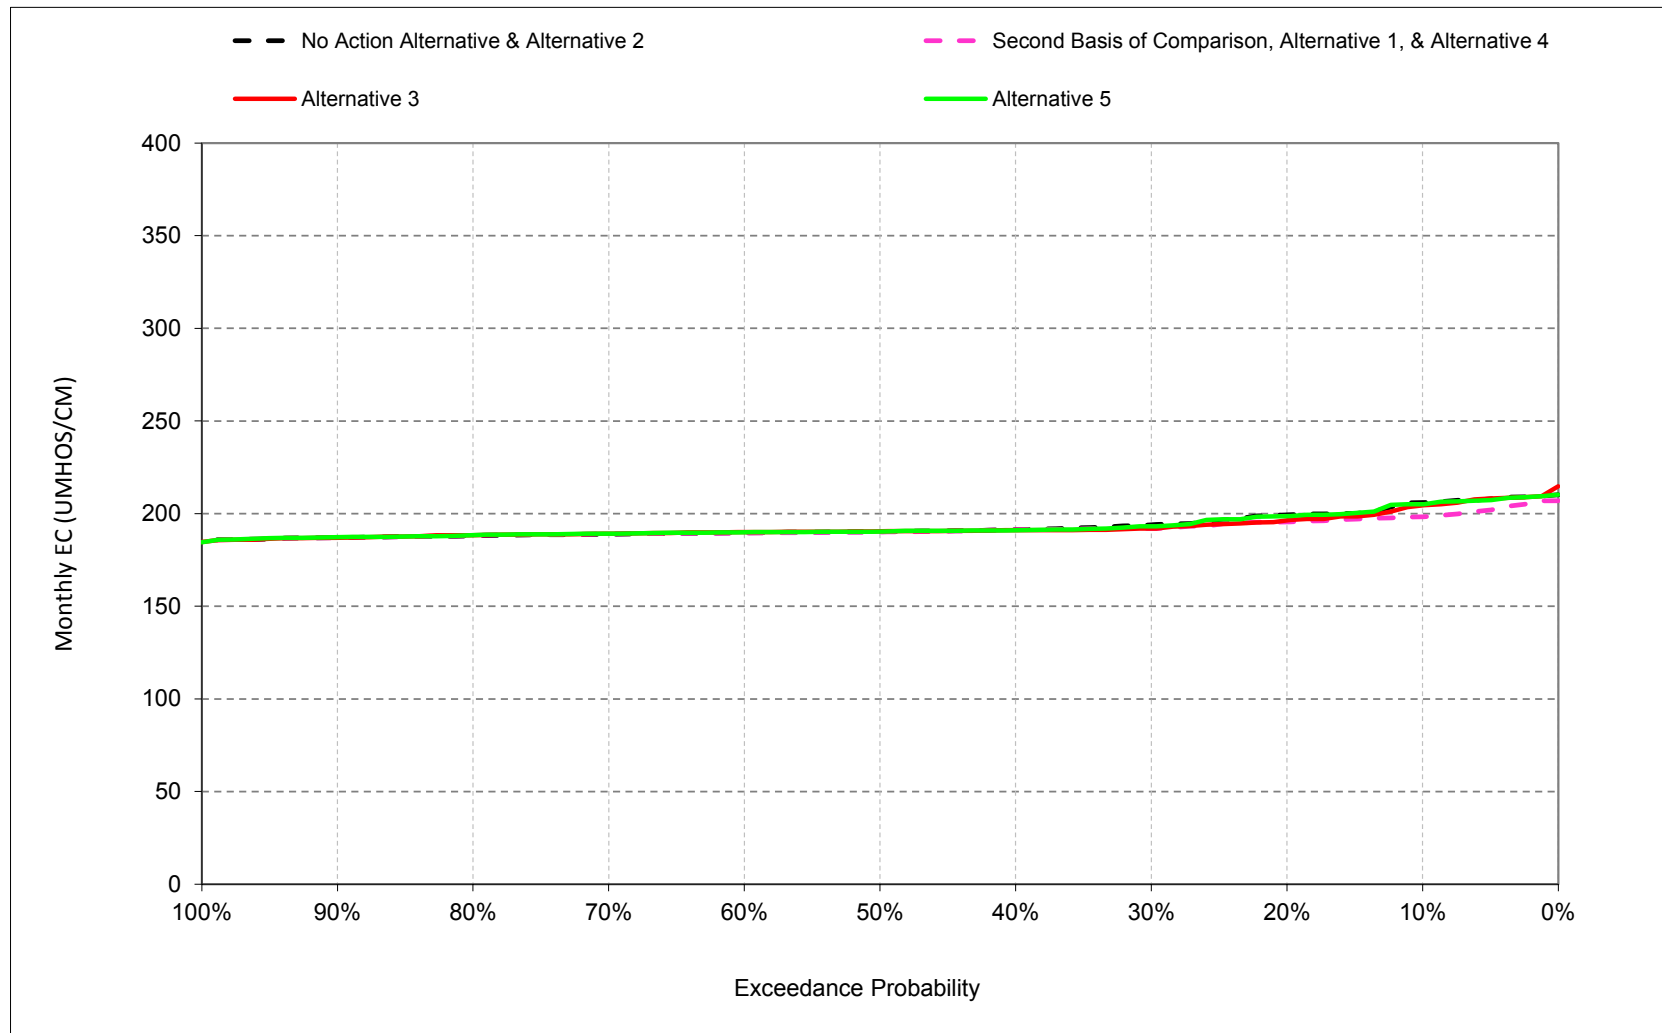


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.14.2. Barker Slough North Bay Aqueduct Intake Salinity, Electrical Conductivity, November

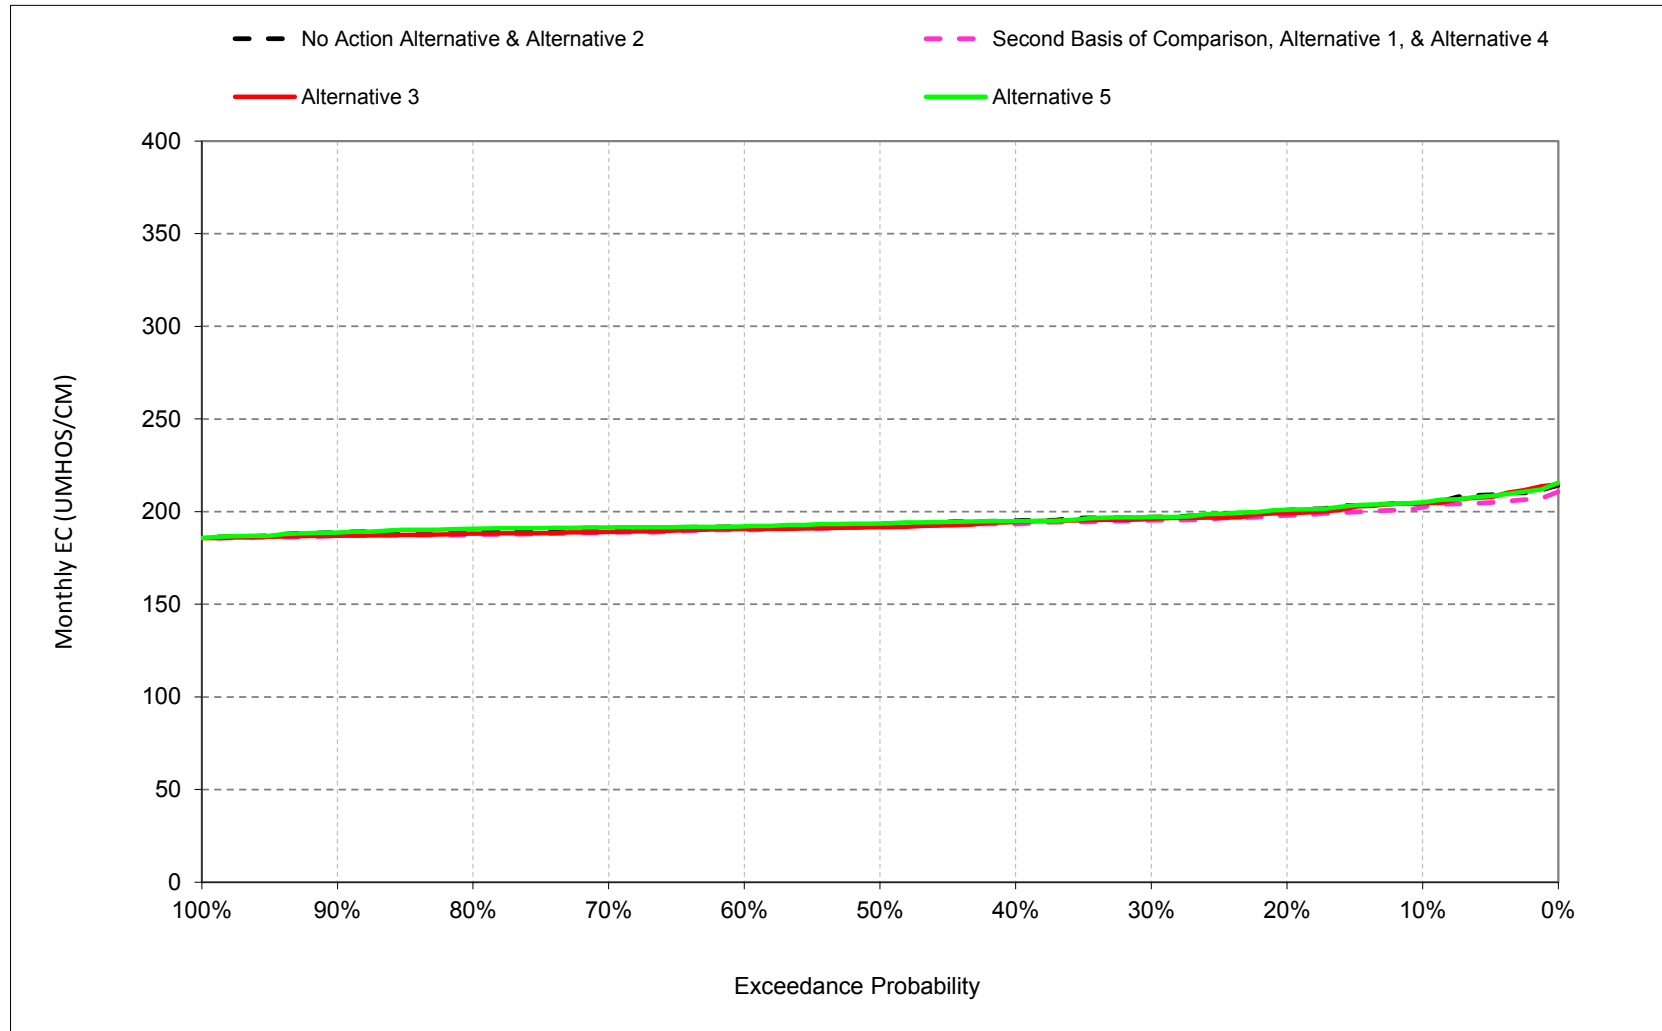


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.14.3. Barker Slough North Bay Aqueduct Intake Salinity, Electrical Conductivity, December

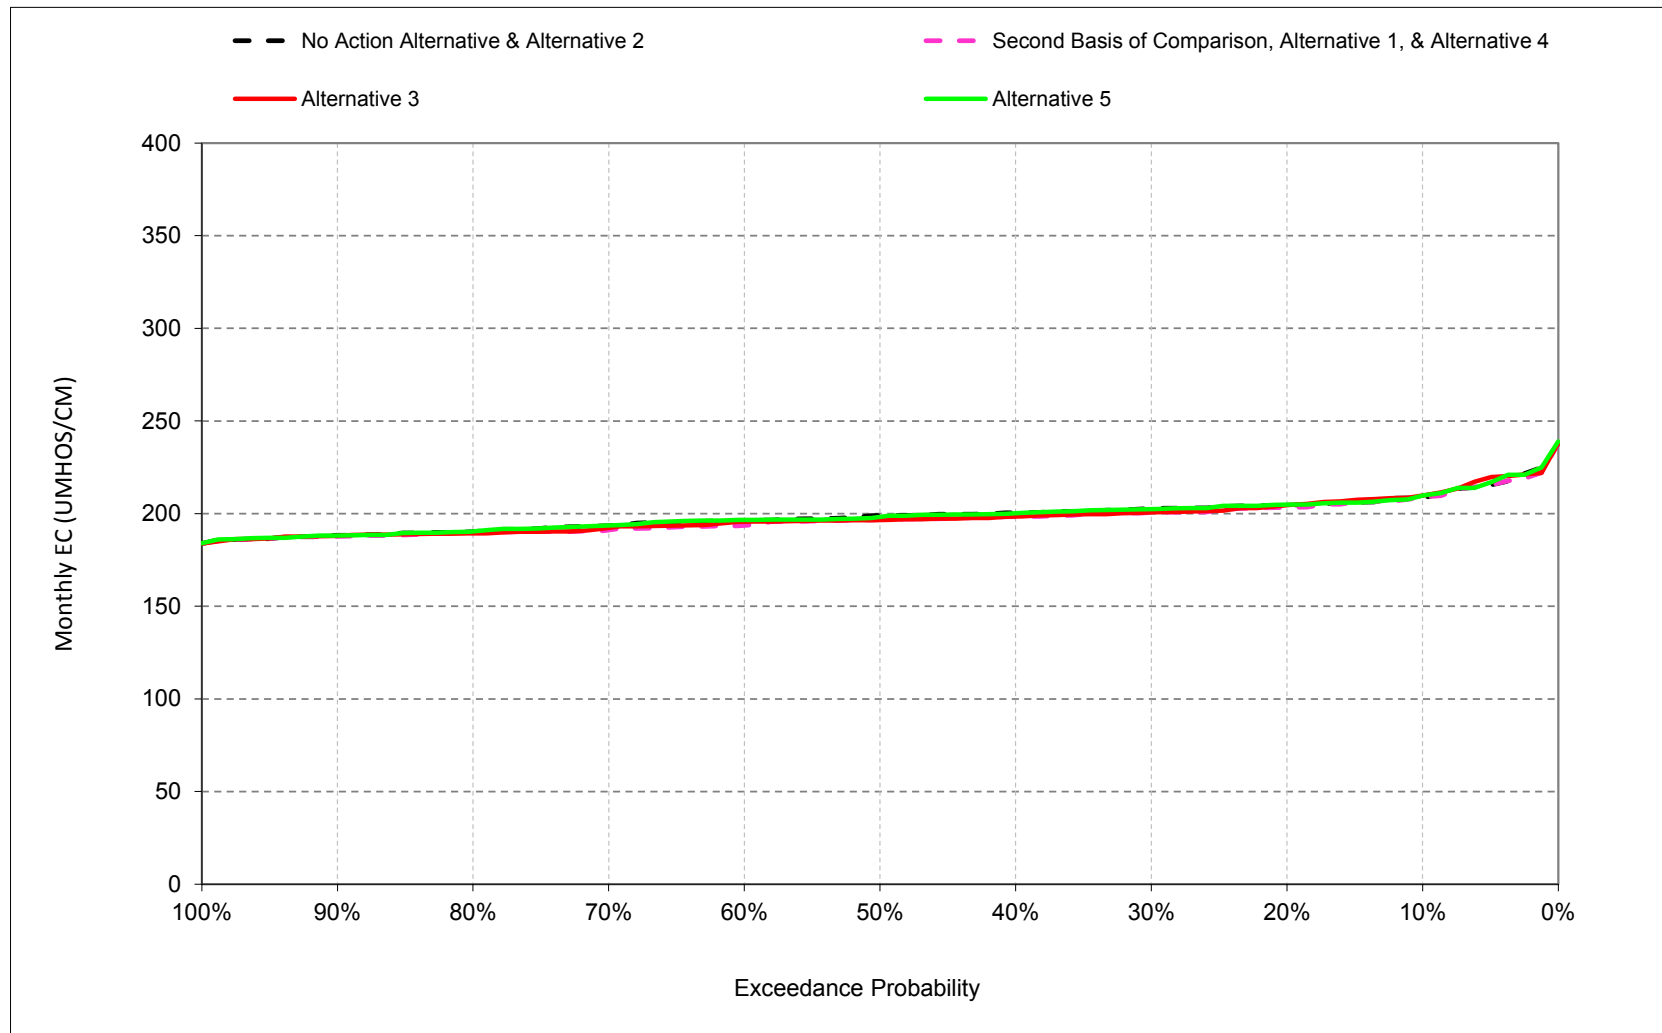


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.14.4. Barker Slough North Bay Aqueduct Intake Salinity, Electrical Conductivity, January

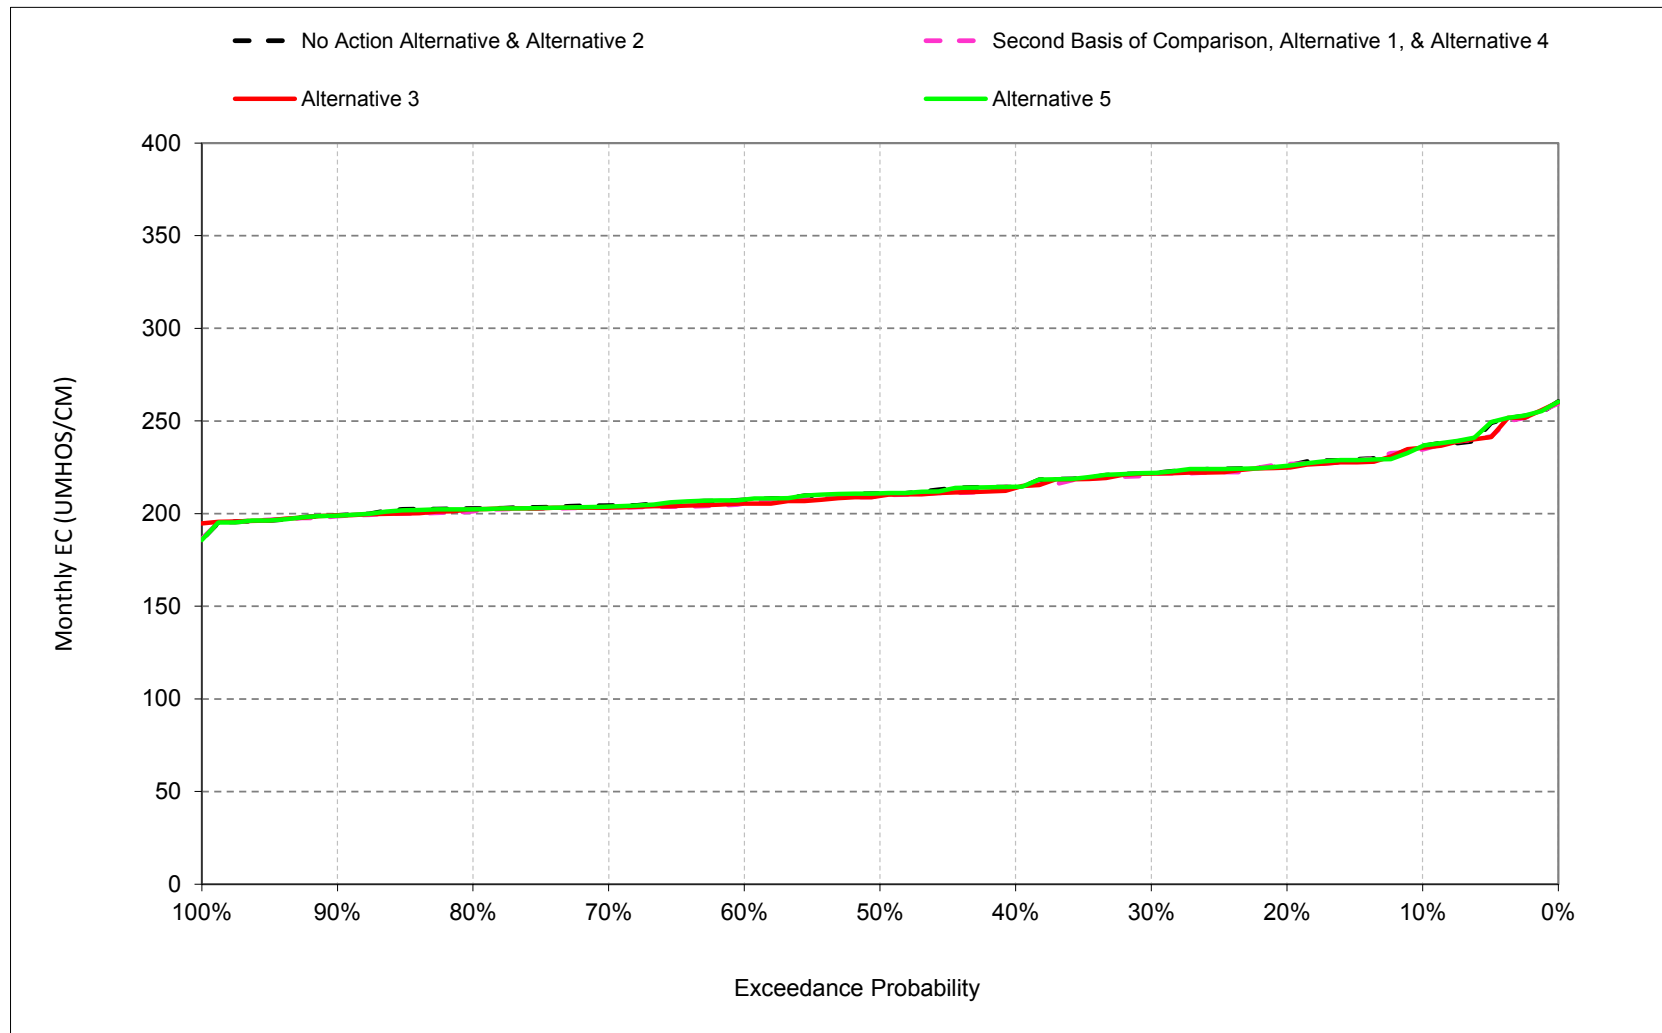


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.14.5. Barker Slough North Bay Aqueduct Intake Salinity, Electrical Conductivity, February

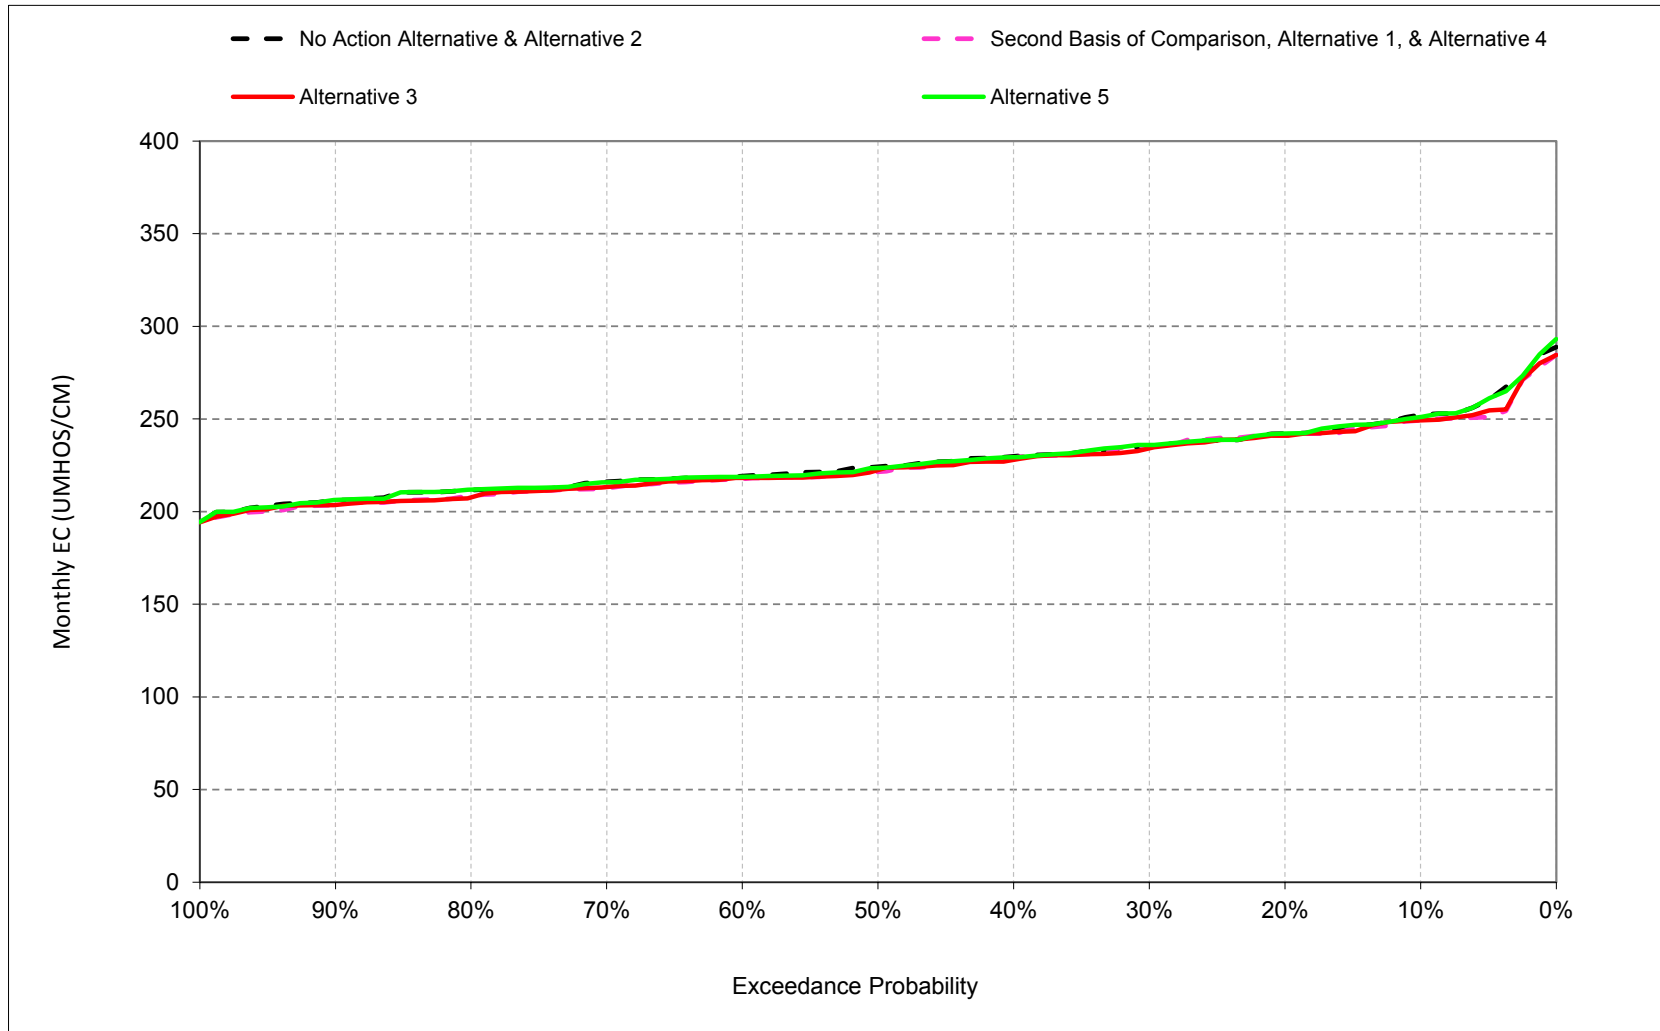


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.14.6. Barker Slough North Bay Aqueduct Intake Salinity, Electrical Conductivity, March

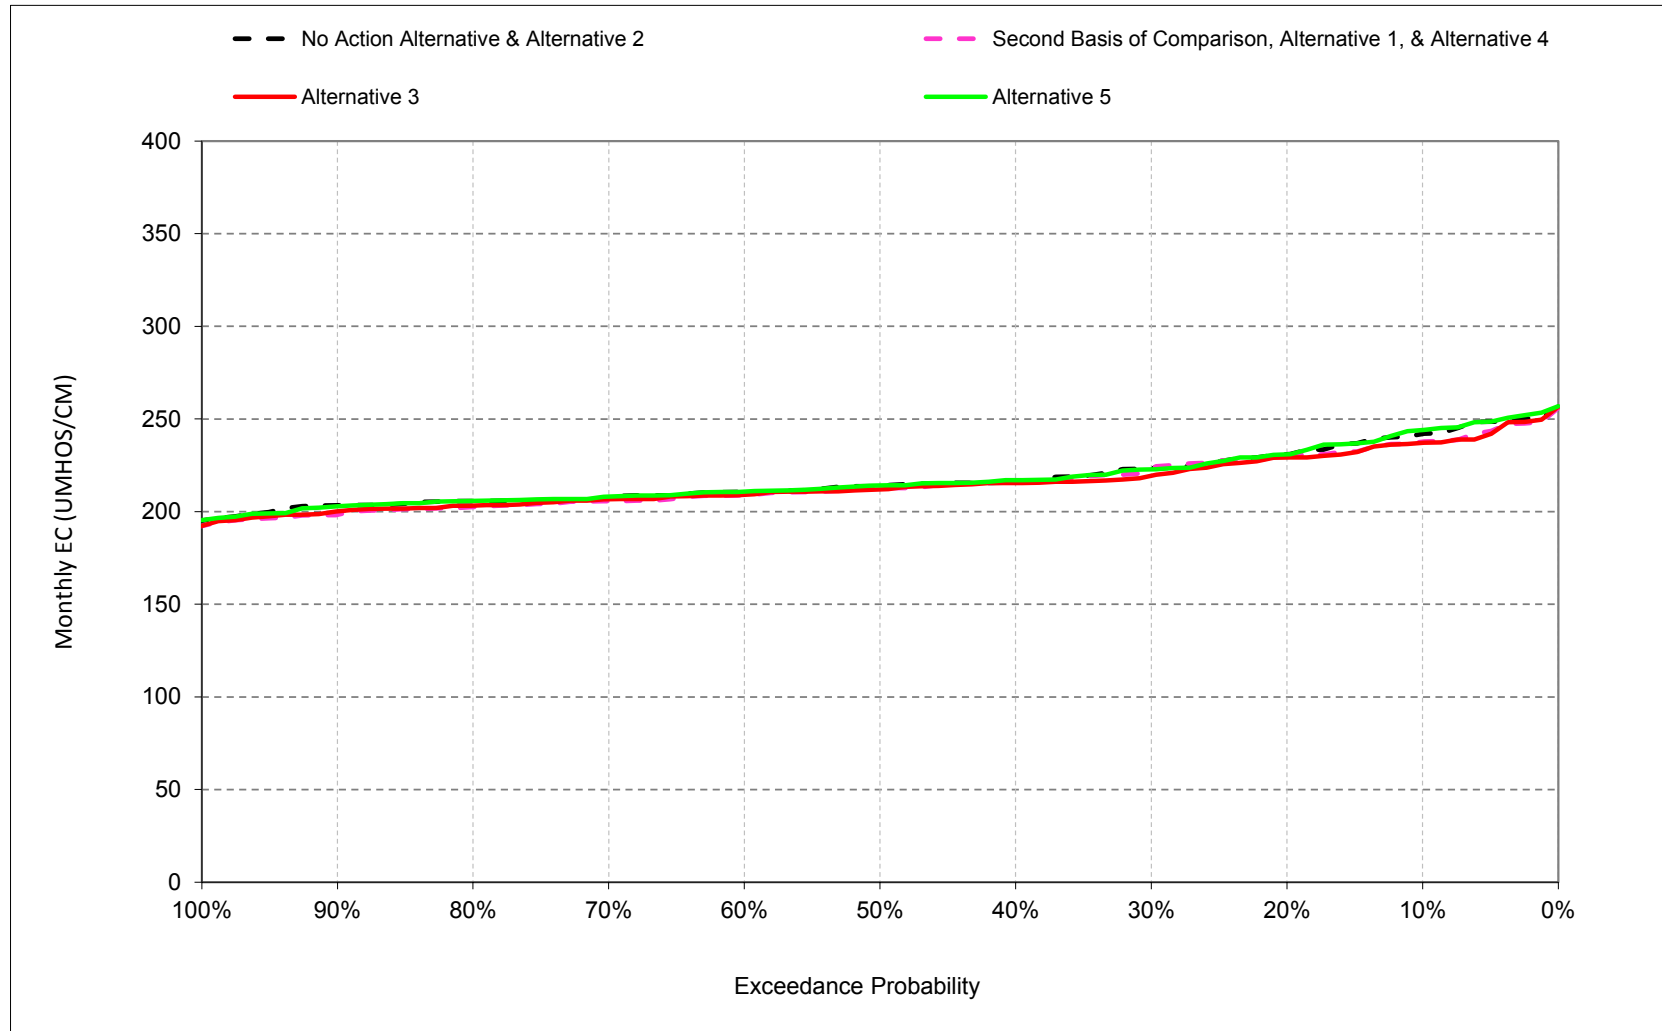


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.14.7. Barker Slough North Bay Aqueduct Intake Salinity, Electrical Conductivity, April

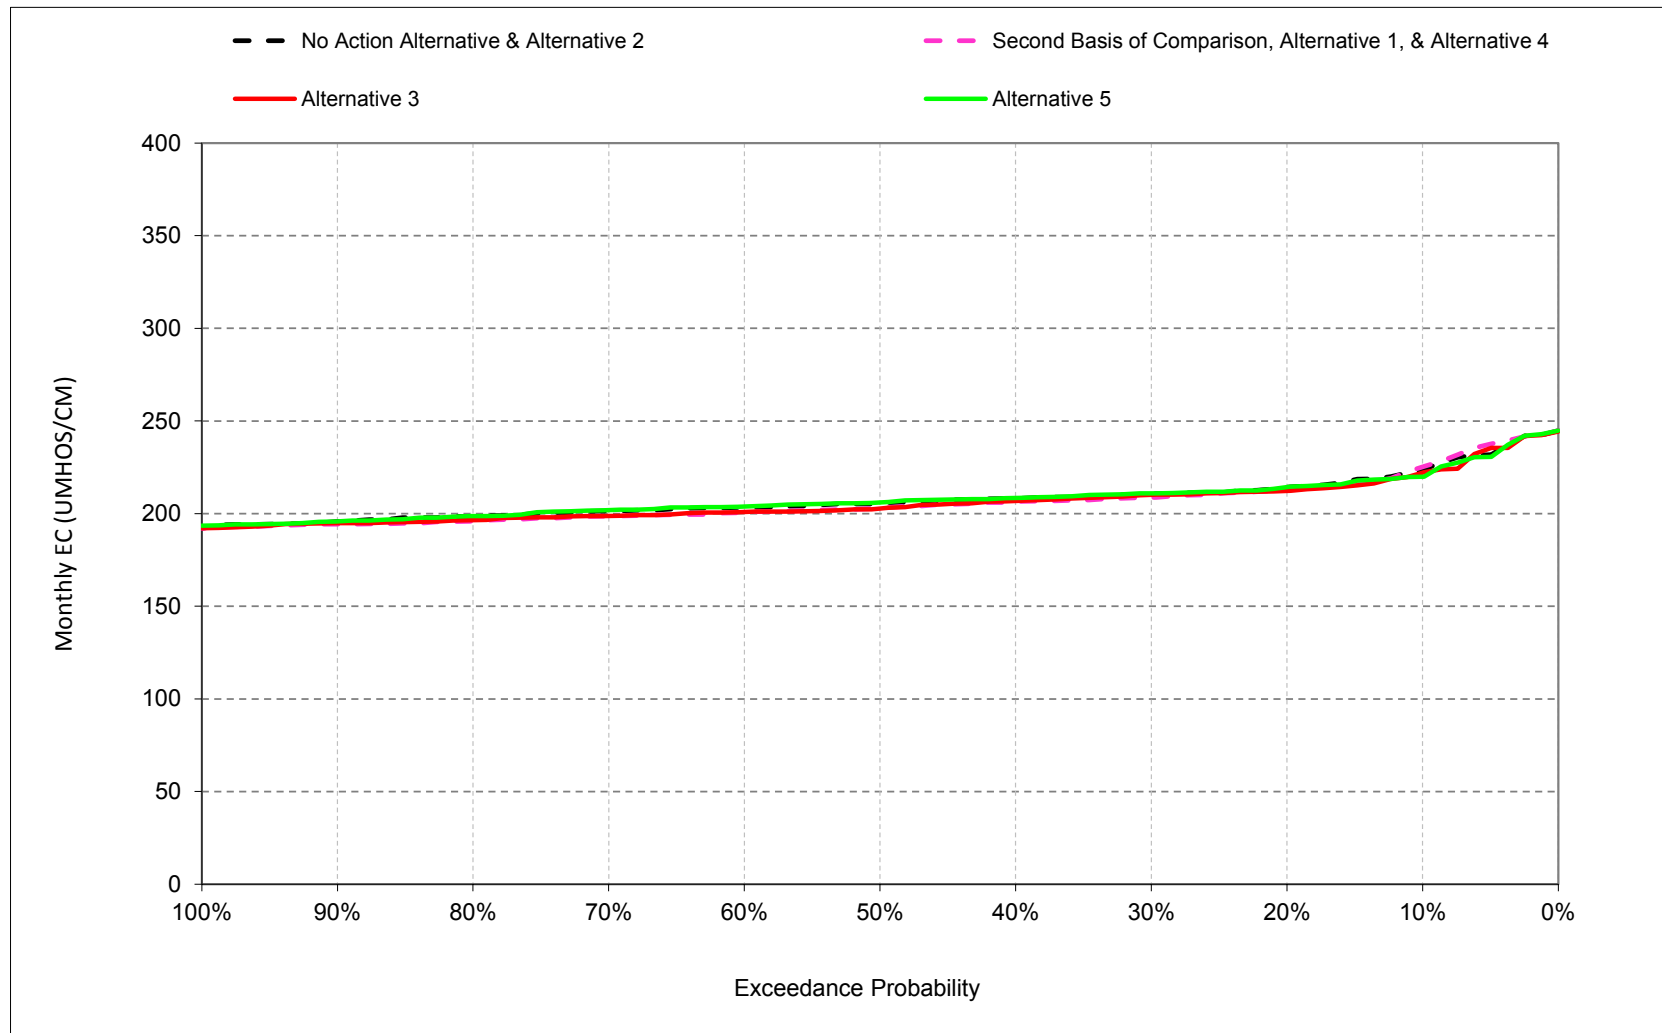


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.14.8. Barker Slough North Bay Aqueduct Intake Salinity, Electrical Conductivity, May

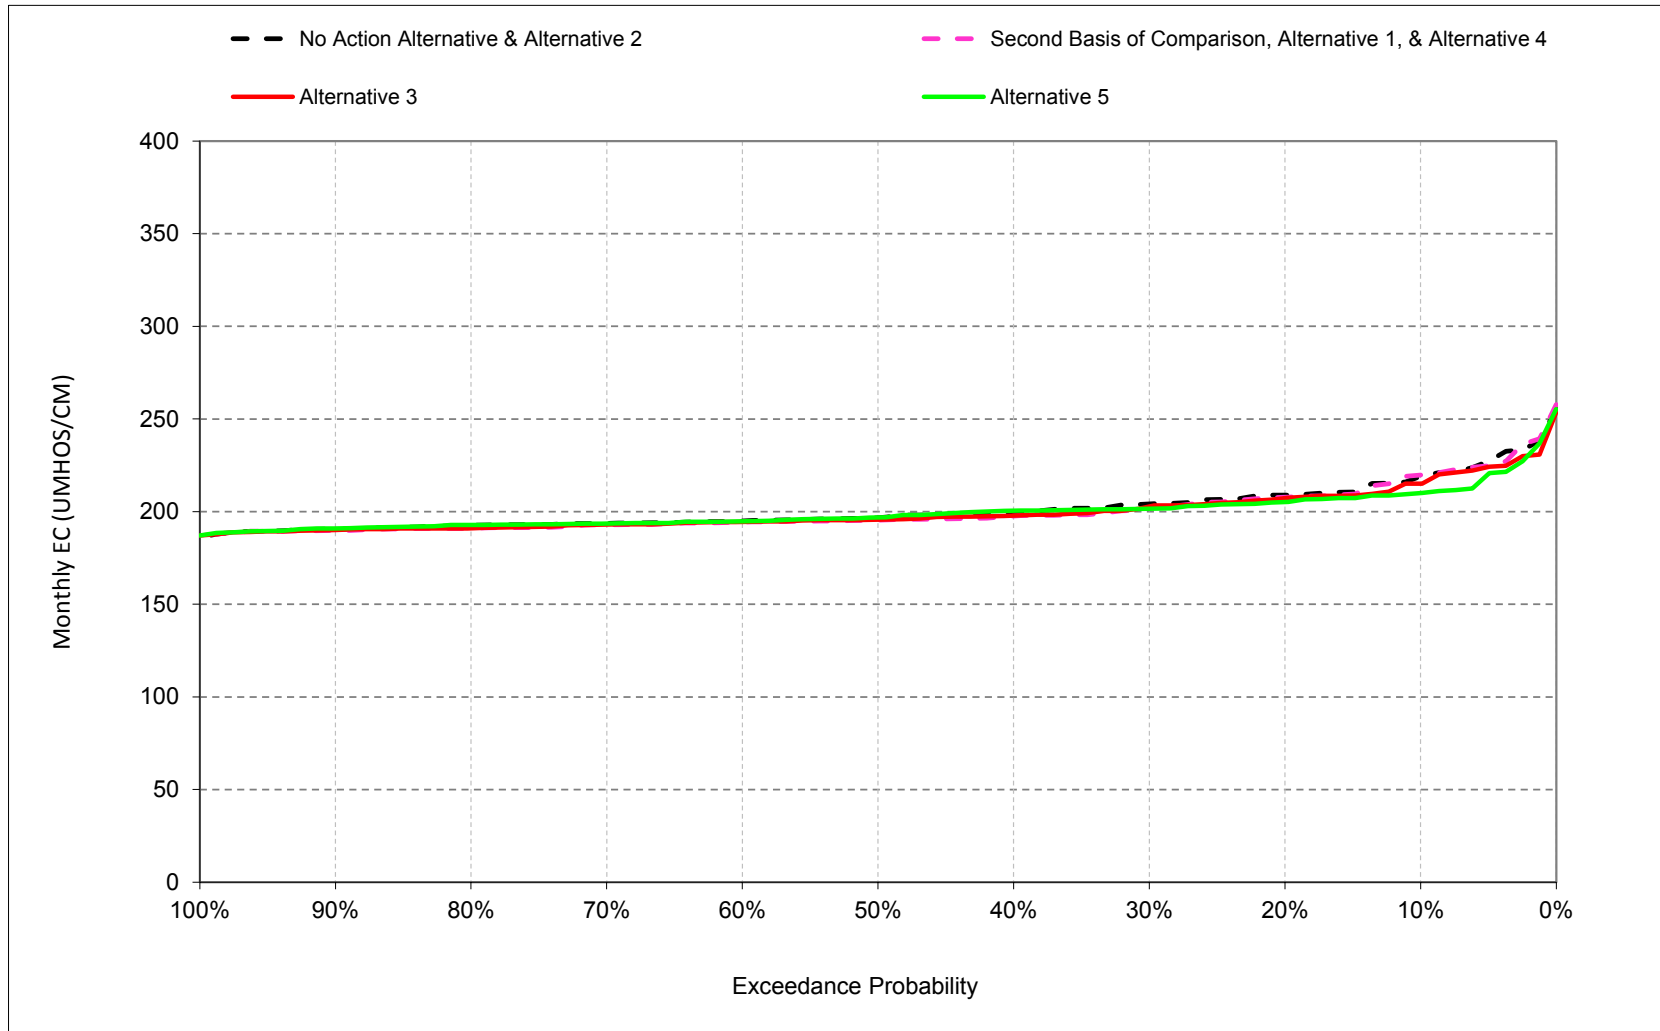


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.14.9. Barker Slough North Bay Aqueduct Intake Salinity, Electrical Conductivity, June

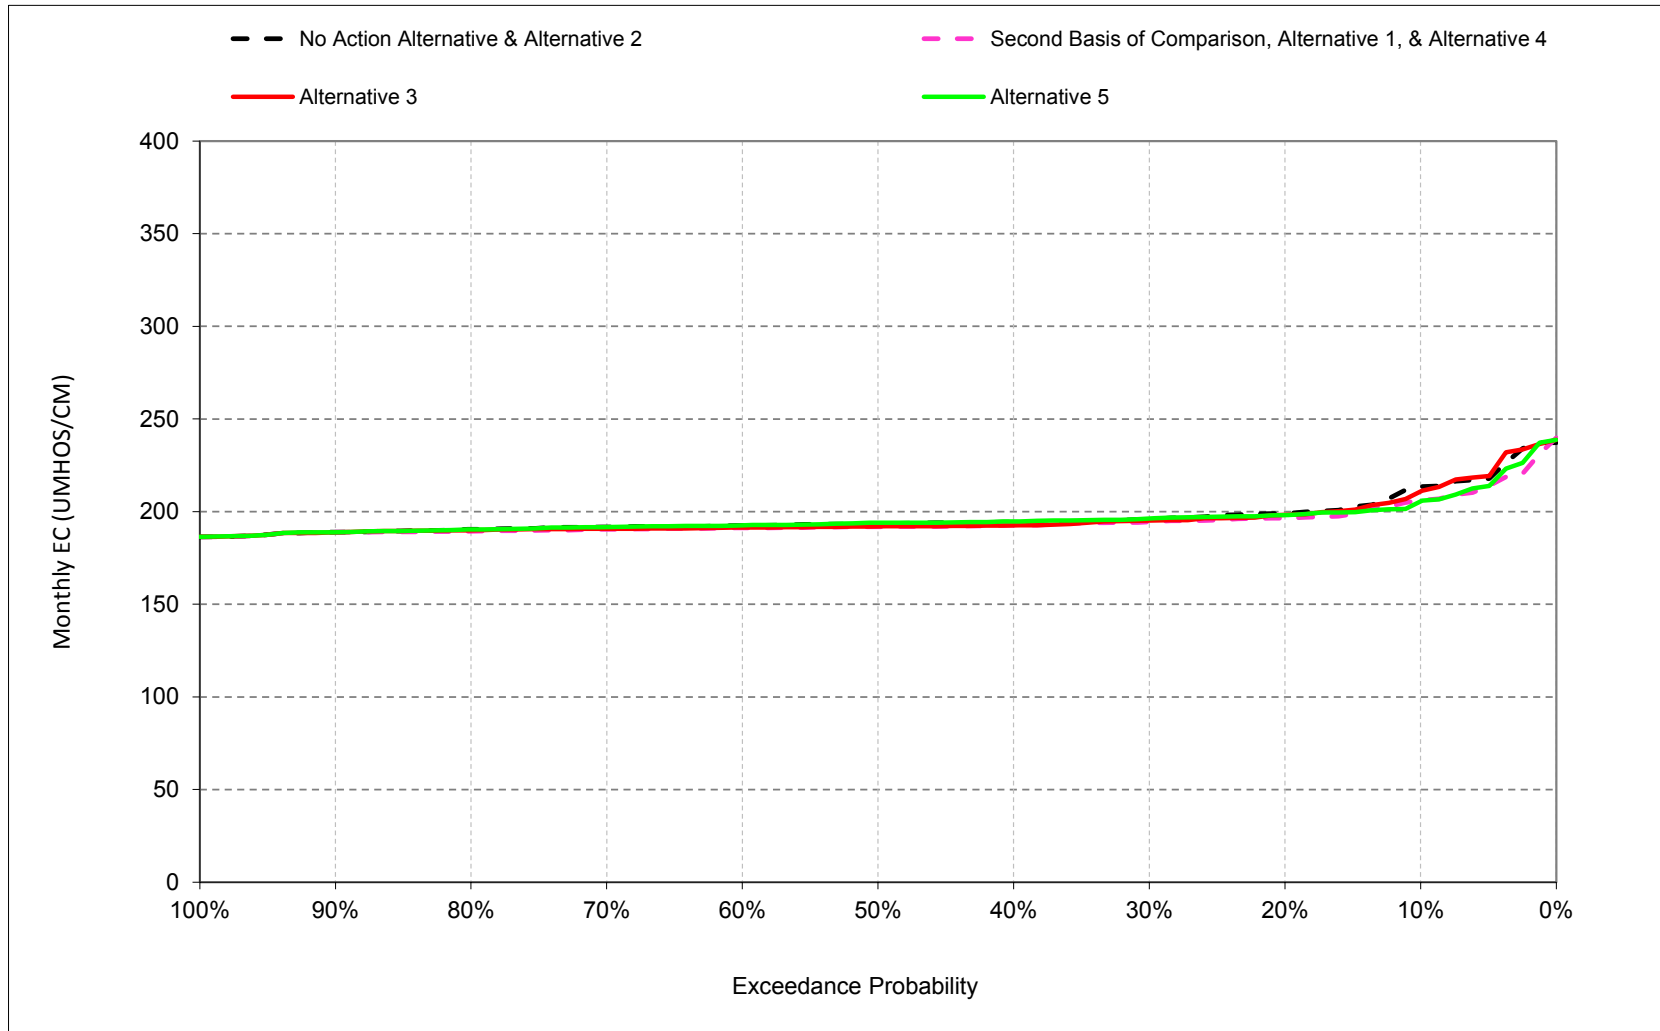


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.14.10. Barker Slough North Bay Aqueduct Intake Salinity, Electrical Conductivity, July

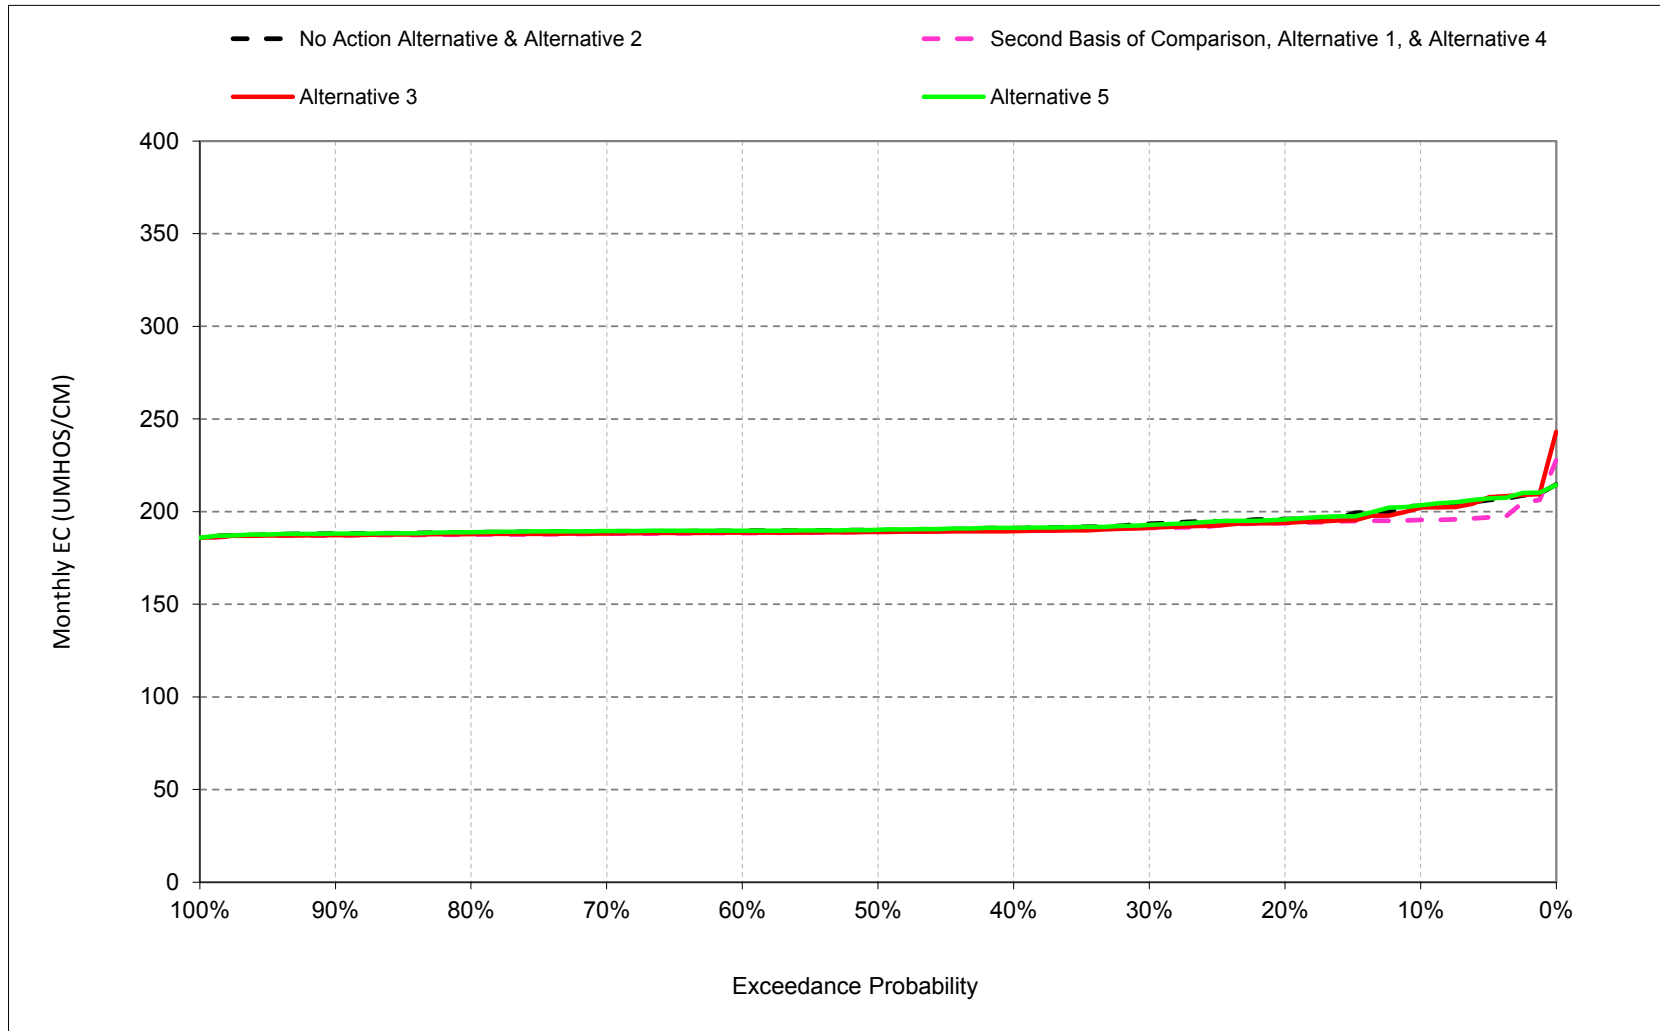


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.14.11. Barker Slough North Bay Aqueduct Intake Salinity, Electrical Conductivity, August

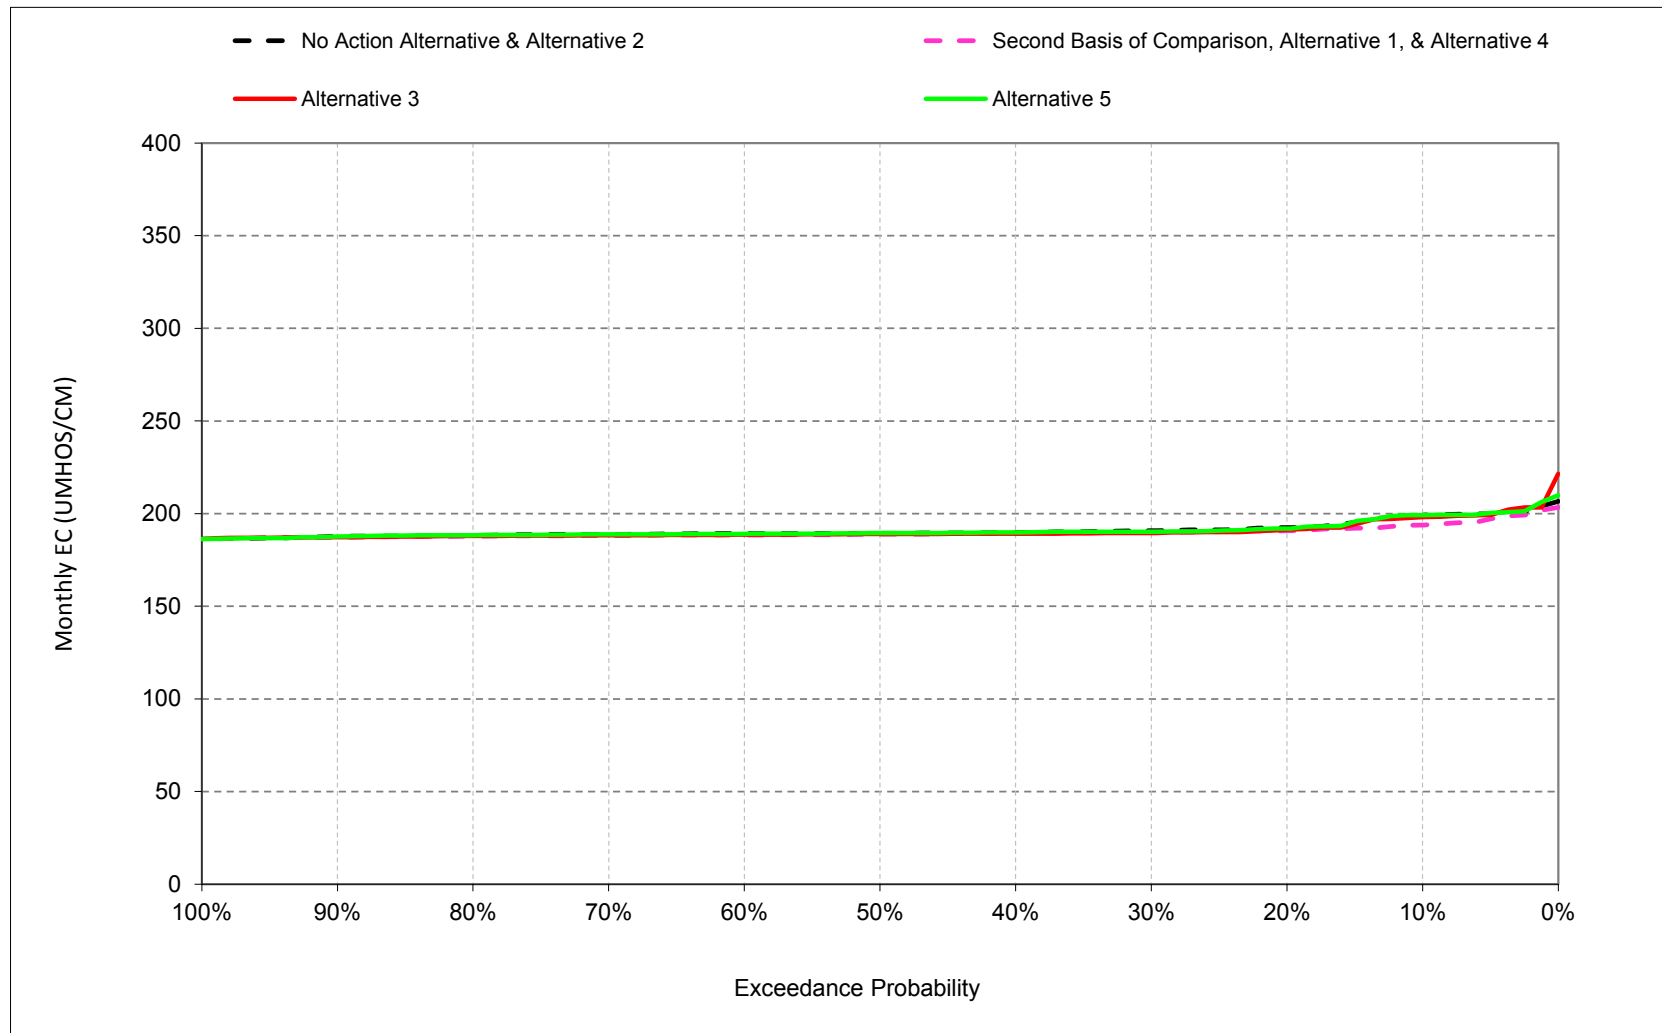

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.14.12. Barker Slough North Bay Aqueduct Intake Salinity, Electrical Conductivity, September

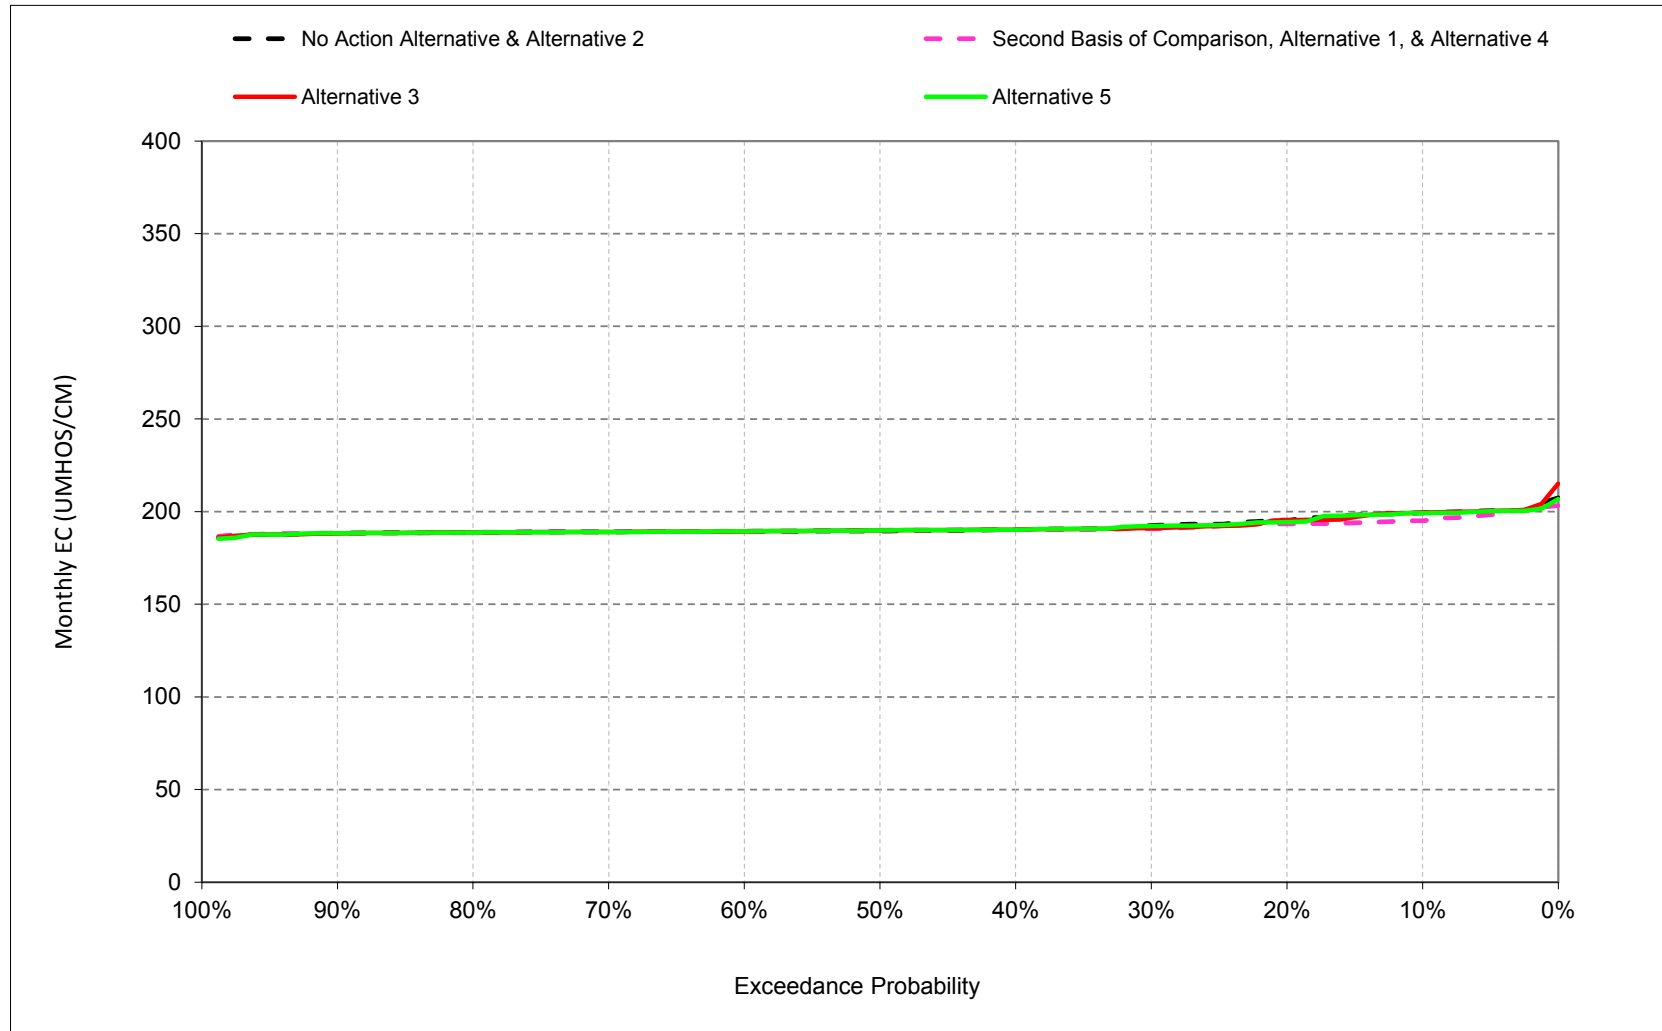

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.14.1. Barker Slough North Bay Aqueduct Intake Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	206	204	209	236	252	242	224	219	213	203	199	199
20%	199	201	205	226	242	231	214	209	199	196	192	195
30%	194	197	203	222	236	223	211	204	196	193	191	193
40%	191	195	200	214	230	216	208	200	194	191	190	190
50%	190	193	199	211	224	214	206	197	193	190	189	190
60%	190	192	196	207	219	211	203	195	192	190	189	189
70%	189	191	193	204	216	207	201	194	192	189	189	189
80%	188	190	190	203	212	206	199	193	190	189	188	189
90%	187	189	188	199	206	203	196	191	189	188	188	188
Long Term												
Full Simulation Period ^b	193	195	199	215	227	218	208	202	197	193	191	192
Water Year Types ^c												
Wet (32%)	190	193	199	217	229	214	201	193	191	189	189	189
Above Normal (16%)	193	195	200	218	231	216	203	195	192	189	188	189
Below Normal (13%)	191	193	197	210	224	221	211	203	193	190	189	190
Dry (24%)	195	197	198	214	229	221	211	206	199	195	192	193
Critical (15%)	198	200	203	213	222	221	222	220	215	203	199	200
Alternative 1												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	198	202	209	235	249	238	225	220	206	195	194	195
20%	196	198	203	227	241	230	213	208	196	194	191	193
30%	192	195	201	221	236	223	209	202	195	191	190	191
40%	191	193	198	215	229	216	206	198	193	190	189	190
50%	190	192	197	210	222	213	203	195	192	189	189	190
60%	190	190	194	206	218	209	201	194	191	188	189	189
70%	189	189	191	203	213	206	199	193	190	188	188	189
80%	188	188	190	201	209	203	196	191	189	188	188	189
90%	187	187	188	199	204	198	194	190	189	187	187	188
Long Term												
Full Simulation Period ^b	192	193	198	214	225	216	207	200	195	191	190	191
Water Year Types ^c												
Wet (32%)	190	191	198	216	225	212	200	192	190	188	189	190
Above Normal (16%)	192	193	199	218	227	210	199	193	191	188	188	189
Below Normal (13%)	191	192	196	209	220	214	206	197	191	188	189	189
Dry (24%)	193	194	195	213	230	222	210	204	196	192	190	192
Critical (15%)	195	197	202	213	222	223	223	222	211	199	196	197
Alternative 1 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-8	-2	0	-2	-3	-4	2	1	-7	-8	-5	-4
20%	-4	-3	-1	1	-1	-1	-2	-1	-3	-2	-2	-2
30%	-2	-2	-2	-1	0	0	-2	-2	-1	-2	-1	-2
40%	0	-2	-2	1	-1	0	-2	-2	-2	-1	0	0
50%	0	-2	-2	-1	-3	-1	-3	-1	-2	-1	-1	0
60%	0	-2	-3	-2	-2	-2	-3	-1	-1	-1	-1	0
70%	0	-3	-2	-1	-3	-2	-3	-1	-1	-1	-1	0
80%	0	-2	-1	-1	-3	-3	-3	-2	-1	-1	0	0
90%	0	-2	-1	0	-3	-5	-1	-1	0	-1	0	0
Long Term												
Full Simulation Period ^b	-1	-2	-1	-1	-2	-2	-2	-1	-2	-2	-1	-1
Water Year Types ^c												
Wet (32%)	0	-2	-1	-2	-4	-2	-1	0	0	0	0	0
Above Normal (16%)	-1	-2	-1	0	-4	-6	-4	-2	-2	-1	-1	0
Below Normal (13%)	0	-1	-1	-2	-4	-7	-4	-6	-2	-2	0	0
Dry (24%)	-3	-3	-2	-1	1	1	-1	-1	-3	-3	-2	-2
Critical (15%)	-3	-3	-1	0	0	2	1	2	-4	-4	-3	-2

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.14.2. Barker Slough North Bay Aqueduct Intake Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	206	204	209	236	252	242	224	219	213	203	199	199
20%	199	201	205	226	242	231	214	209	199	196	192	195
30%	194	197	203	222	236	223	211	204	196	193	191	193
40%	191	195	200	214	230	216	208	200	194	191	190	190
50%	190	193	199	211	224	214	206	197	193	190	189	190
60%	190	192	196	207	219	211	203	195	192	190	189	189
70%	189	191	193	204	216	207	201	194	192	189	189	189
80%	188	190	190	203	212	206	199	193	190	189	188	189
90%	187	189	188	199	206	203	196	191	189	188	188	188
Long Term												
Full Simulation Period ^b	193	195	199	215	227	218	208	202	197	193	191	192
Water Year Types ^c												
Wet (32%)	190	193	199	217	229	214	201	193	191	189	189	189
Above Normal (16%)	193	195	200	218	231	216	203	195	192	189	188	189
Below Normal (13%)	191	193	197	210	224	221	211	203	193	190	189	190
Dry (24%)	195	197	198	214	229	221	211	206	199	195	192	193
Critical (15%)	198	200	203	213	222	221	222	220	215	203	199	200

Alternative 3												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	204	205	210	236	249	237	222	215	211	202	198	199
20%	196	199	205	225	241	229	212	207	198	194	191	195
30%	192	196	201	222	234	219	210	203	195	191	190	191
40%	191	194	198	214	228	215	207	198	193	189	189	190
50%	190	192	197	210	222	212	203	196	192	189	189	190
60%	190	191	196	205	218	209	201	194	191	189	189	189
70%	189	189	192	203	213	207	199	193	191	188	188	189
80%	188	188	189	202	208	203	197	191	190	188	188	189
90%	187	187	188	199	204	200	195	190	189	187	187	188
Long Term												
Full Simulation Period ^b	193	194	198	214	225	216	206	200	196	192	191	192
Water Year Types ^c												
Wet (32%)	190	192	198	216	226	212	200	193	190	188	189	190
Above Normal (16%)	193	193	199	218	228	212	199	193	191	188	188	189
Below Normal (13%)	191	192	196	210	219	214	206	196	191	188	188	189
Dry (24%)	195	196	197	213	229	221	211	204	198	193	190	193
Critical (15%)	197	198	202	212	222	221	221	219	216	205	200	200

Alternative 3 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-1	0	1	-1	-3	-5	-2	-4	-3	-1	-1	0
20%	-3	-1	0	-1	-1	-2	-2	-2	-1	-2	-1	0
30%	-2	-1	-2	0	-2	-4	0	-1	-1	-2	-1	-1
40%	0	-1	-2	0	-2	-1	-1	-2	-2	-2	-1	0
50%	0	-2	-2	-1	-2	-2	-3	-1	-1	-1	0	0
60%	0	-1	-1	-2	-1	-2	-3	-1	-1	-1	-1	0
70%	0	-2	-1	-1	-3	-1	-3	-1	-1	-1	0	0
80%	0	-2	-1	0	-4	-2	-2	-2	0	-1	0	0
90%	0	-2	0	0	-2	-3	-1	0	0	-1	0	0
Long Term												
Full Simulation Period ^b	0	-1	-1	-1	-2	-2	-2	-2	-1	-1	0	0
Water Year Types ^c												
Wet (32%)	0	-1	-1	-2	-3	-2	-1	0	0	-1	0	0
Above Normal (16%)	-1	-2	-1	0	-3	-4	-3	-1	-1	-1	0	0
Below Normal (13%)	0	-1	0	-1	-5	-7	-4	-7	-2	-2	0	-1
Dry (24%)	0	-1	-1	-1	0	0	-1	-1	-1	-2	-1	-1
Critical (15%)	-1	-2	-2	0	0	0	-1	-1	1	2	1	1

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.14.3. Barker Slough North Bay Aqueduct Intake Salinity, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	206	204	209	236	252	242	224	219	213	203	199	199
20%	199	201	205	226	242	231	214	209	199	196	192	195
30%	194	197	203	222	236	223	211	204	196	193	191	193
40%	191	195	200	214	230	216	208	200	194	191	190	190
50%	190	193	199	211	224	214	206	197	193	190	189	190
60%	190	192	196	207	219	211	203	195	192	190	189	189
70%	189	191	193	204	216	207	201	194	192	189	189	189
80%	188	190	190	203	212	206	199	193	190	189	188	189
90%	187	189	188	199	206	203	196	191	189	188	188	188
Long Term												
Full Simulation Period ^b	193	195	199	215	227	218	208	202	197	193	191	192
Water Year Types ^c												
Wet (32%)	190	193	199	217	229	214	201	193	191	189	189	189
Above Normal (16%)	193	195	200	218	231	216	203	195	192	189	188	189
Below Normal (13%)	191	193	197	210	224	221	211	203	193	190	189	190
Dry (24%)	195	197	198	214	229	221	211	206	199	195	192	193
Critical (15%)	198	200	203	213	222	221	222	220	215	203	199	200
Alternative 5												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	205	205	210	236	251	244	220	210	205	203	199	199
20%	199	201	205	226	242	231	214	205	198	196	192	194
30%	193	197	202	222	236	223	211	202	196	193	190	192
40%	191	195	200	215	229	217	208	201	195	191	190	190
50%	190	194	198	211	224	214	206	197	194	190	189	190
60%	190	192	197	208	219	211	204	195	193	190	189	189
70%	189	192	194	204	216	208	202	194	192	189	189	189
80%	188	191	190	202	212	206	199	193	190	189	188	189
90%	187	189	188	199	206	203	196	191	189	188	188	188
Long Term												
Full Simulation Period ^b	193	196	199	215	227	218	208	200	196	193	191	192
Water Year Types ^c												
Wet (32%)	190	193	199	217	229	214	201	193	191	189	189	189
Above Normal (16%)	193	195	200	218	231	216	203	195	192	189	189	189
Below Normal (13%)	192	194	197	211	224	220	210	199	193	190	189	189
Dry (24%)	195	197	198	214	229	221	211	204	199	195	191	193
Critical (15%)	198	200	203	212	222	221	222	216	211	204	200	199
Alternative 5 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-1	1	1	0	-1	2	-4	-9	-8	0	0	0
20%	-1	0	0	0	0	0	0	-4	-1	0	-1	-1
30%	-1	0	0	0	0	0	-1	0	-3	0	-1	0
40%	0	0	0	0	0	1	0	1	0	0	0	0
50%	0	0	-1	0	-1	0	0	0	1	0	0	0
60%	0	0	0	0	0	0	0	0	0	0	0	0
70%	0	0	0	-1	0	1	0	0	0	0	0	0
80%	0	1	0	0	0	0	0	0	0	0	0	0
90%	0	0	0	0	0	0	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	0	0	0	0	0	0	0	-2	-1	0	0	0
Water Year Types ^c												
Wet (32%)	0	0	0	0	0	0	0	0	0	0	0	0
Above Normal (16%)	0	0	0	0	0	0	0	0	0	0	0	0
Below Normal (13%)	1	1	0	0	-1	0	-1	-4	0	0	0	0
Dry (24%)	0	0	0	0	0	0	0	-2	-1	0	0	0
Critical (15%)	0	0	0	0	0	0	0	-4	-4	1	1	-1

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.14.4. Barker Slough North Bay Aqueduct Intake Salinity, Monthly EC

Second Basis of Comparison

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	198	202	209	235	249	238	225	220	206	195	194	195
20%	196	198	203	227	241	230	213	208	196	194	191	193
30%	192	195	201	221	236	223	209	202	195	191	190	191
40%	191	193	198	215	229	216	206	198	193	190	189	190
50%	190	192	197	210	222	213	203	195	192	189	189	190
60%	190	190	194	206	218	209	201	194	191	188	189	189
70%	189	189	191	203	213	206	199	193	190	188	188	189
80%	188	188	190	201	209	203	196	191	189	188	188	189
90%	187	187	188	199	204	198	194	190	189	187	187	188
Long Term												
Full Simulation Period ^b	192	193	198	214	225	216	207	200	195	191	190	191
Water Year Types^c												
Wet (32%)	190	191	198	216	225	212	200	192	190	188	189	190
Above Normal (16%)	192	193	199	218	227	210	199	193	191	188	188	189
Below Normal (13%)	191	192	196	209	220	214	206	197	191	188	189	189
Dry (24%)	193	194	195	213	230	222	210	204	196	192	190	192
Critical (15%)	195	197	202	213	222	223	223	222	211	199	196	197

No Action Alternative

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	206	204	209	236	252	242	224	219	213	203	199	199
20%	199	201	205	226	242	231	214	209	199	196	192	195
30%	194	197	203	222	236	223	211	204	196	193	191	193
40%	191	195	200	214	230	216	208	200	194	191	190	190
50%	190	193	199	211	224	214	206	197	193	190	189	190
60%	190	192	196	207	219	211	203	195	192	190	189	189
70%	189	191	193	204	216	207	201	194	192	189	189	189
80%	188	190	190	203	212	206	199	193	190	189	188	189
90%	187	189	188	199	206	203	196	191	189	188	188	188
Long Term												
Full Simulation Period ^b	193	195	199	215	227	218	208	202	197	193	191	192
Water Year Types^c												
Wet (32%)	190	193	199	217	229	214	201	193	191	189	189	189
Above Normal (16%)	193	195	200	218	231	216	203	195	192	189	188	189
Below Normal (13%)	191	193	197	210	224	221	211	203	193	190	189	190
Dry (24%)	195	197	198	214	229	221	211	206	199	195	192	193
Critical (15%)	198	200	203	213	222	221	222	220	215	203	199	200

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	8	2	0	2	3	4	-2	-1	7	8	5	4
20%	4	3	1	-1	1	1	2	1	3	2	2	2
30%	2	2	2	1	0	0	2	2	1	2	1	2
40%	0	2	2	-1	1	0	2	2	2	1	0	0
50%	0	2	2	1	3	1	3	1	2	1	1	0
60%	0	2	3	2	2	2	3	1	1	1	1	0
70%	0	3	2	1	3	2	3	1	1	1	1	0
80%	0	2	1	1	3	3	3	2	1	1	0	0
90%	0	2	1	0	3	5	1	1	0	1	0	0
Long Term												
Full Simulation Period ^b	1	2	1	1	2	2	2	1	2	2	1	1
Water Year Types^c												
Wet (32%)	0	2	1	2	4	2	1	0	0	0	0	0
Above Normal (16%)	1	2	1	0	4	6	4	2	2	1	1	0
Below Normal (13%)	0	1	1	2	4	7	4	6	2	2	0	0
Dry (24%)	3	3	2	1	-1	-1	1	1	3	3	2	2
Critical (15%)	3	3	1	0	0	-2	-1	-2	4	4	3	2

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.14.5. Barker Slough North Bay Aqueduct Intake Salinity, Monthly EC

Second Basis of Comparison

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	198	202	209	235	249	238	225	220	206	195	194	195
20%	196	198	203	227	241	230	213	208	196	194	191	193
30%	192	195	201	221	236	223	209	202	195	191	190	191
40%	191	193	198	215	229	216	206	198	193	190	189	190
50%	190	192	197	210	222	213	203	195	192	189	189	190
60%	190	190	194	206	218	209	201	194	191	188	189	189
70%	189	189	191	203	213	206	199	193	190	188	188	189
80%	188	188	190	201	209	203	196	191	189	188	188	189
90%	187	187	188	199	204	198	194	190	189	187	187	188
Long Term												
Full Simulation Period ^b	192	193	198	214	225	216	207	200	195	191	190	191
Water Year Types ^c												
Wet (32%)	190	191	198	216	225	212	200	192	190	188	189	190
Above Normal (16%)	192	193	199	218	227	210	199	193	191	188	188	189
Below Normal (13%)	191	192	196	209	220	214	206	197	191	188	189	189
Dry (24%)	193	194	195	213	230	222	210	204	196	192	190	192
Critical (15%)	195	197	202	213	222	223	223	222	211	199	196	197

Alternative 3

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	204	205	210	236	249	237	222	215	211	202	198	199
20%	196	199	205	225	241	229	212	207	198	194	191	195
30%	192	196	201	222	234	219	210	203	195	191	190	191
40%	191	194	198	214	228	215	207	198	193	189	189	190
50%	190	192	197	210	222	212	203	196	192	189	189	190
60%	190	191	196	205	218	209	201	194	191	189	189	189
70%	189	189	192	203	213	207	199	193	191	188	188	189
80%	188	188	189	202	208	203	197	191	190	188	188	189
90%	187	187	188	199	204	200	195	190	189	187	187	188
Long Term												
Full Simulation Period ^b	193	194	198	214	225	216	206	200	196	192	191	192
Water Year Types ^c												
Wet (32%)	190	192	198	216	226	212	200	193	190	188	189	190
Above Normal (16%)	193	193	199	218	228	212	199	193	191	188	188	189
Below Normal (13%)	191	192	196	210	219	214	206	196	191	188	188	189
Dry (24%)	195	196	197	213	229	221	211	204	198	193	190	193
Critical (15%)	197	198	202	212	222	221	221	219	216	205	200	200

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	6	2	1	1	0	0	-3	-5	5	7	4	4
20%	1	1	1	-2	0	-1	-1	0	2	0	1	2
30%	0	1	0	0	-1	-4	1	1	1	0	0	0
40%	0	1	0	-1	-1	-1	0	0	0	-1	0	0
50%	0	0	0	0	1	-1	0	0	0	0	0	0
60%	0	0	2	0	1	0	0	0	0	0	0	0
70%	0	0	1	0	1	1	0	0	0	0	0	0
80%	0	1	0	1	-1	1	1	0	1	0	0	0
90%	0	0	0	0	0	2	0	0	0	0	0	0
Long Term												
Full Simulation Period ^b	1	1	1	0	0	0	0	0	1	1	1	1
Water Year Types ^c												
Wet (32%)	0	1	0	0	1	0	0	0	0	0	0	0
Above Normal (16%)	1	0	0	0	1	2	0	0	1	0	0	0
Below Normal (13%)	0	0	0	1	-1	0	0	-1	0	0	0	0
Dry (24%)	2	2	1	0	-1	-1	0	0	2	1	1	1
Critical (15%)	2	1	0	-1	0	-2	-2	-3	4	6	4	3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.14.6. Barker Slough North Bay Aqueduct Intake Salinity, Monthly EC

Second Basis of Comparison												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	198	202	209	235	249	238	225	220	206	195	194	195
20%	196	198	203	227	241	230	213	208	196	194	191	193
30%	192	195	201	221	236	223	209	202	195	191	190	191
40%	191	193	198	215	229	216	206	198	193	190	189	190
50%	190	192	197	210	222	213	203	195	192	189	189	190
60%	190	190	194	206	218	209	201	194	191	188	189	189
70%	189	189	191	203	213	206	199	193	190	188	188	189
80%	188	188	190	201	209	203	196	191	189	188	188	189
90%	187	187	188	199	204	198	194	190	189	187	187	188
Long Term												
Full Simulation Period ^b	192	193	198	214	225	216	207	200	195	191	190	191
Water Year Types ^c												
Wet (32%)	190	191	198	216	225	212	200	192	190	188	189	190
Above Normal (16%)	192	193	199	218	227	210	199	193	191	188	188	189
Below Normal (13%)	191	192	196	209	220	214	206	197	191	188	189	189
Dry (24%)	193	194	195	213	230	222	210	204	196	192	190	192
Critical (15%)	195	197	202	213	222	223	223	222	211	199	196	197

Alternative 5

Alternative 5												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	205	205	210	236	251	244	220	210	205	203	199	199
20%	199	201	205	226	242	231	214	205	198	196	192	194
30%	193	197	202	222	236	223	211	202	196	193	190	192
40%	191	195	200	215	229	217	208	201	195	191	190	190
50%	190	194	198	211	224	214	206	197	194	190	189	190
60%	190	192	197	208	219	211	204	195	193	190	189	189
70%	189	192	194	204	216	208	202	194	192	189	189	189
80%	188	191	190	202	212	206	199	193	190	189	188	189
90%	187	189	188	199	206	203	196	191	189	188	188	188
Long Term												
Full Simulation Period ^b	193	196	199	215	227	218	208	200	196	193	191	192
Water Year Types ^c												
Wet (32%)	190	193	199	217	229	214	201	193	191	189	189	189
Above Normal (16%)	193	195	200	218	231	216	203	195	192	189	189	189
Below Normal (13%)	192	194	197	211	224	220	210	199	193	190	189	189
Dry (24%)	195	197	198	214	229	221	211	204	199	195	191	193
Critical (15%)	198	200	203	212	222	221	222	216	211	204	200	199

Alternative 5 minus Second Basis of Comparison

Alternative 5 minus Second Basis of Comparison												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	7	3	1	2	2	6	-5	-10	-1	8	5	4
20%	3	3	1	-1	1	1	2	-3	2	2	1	1
30%	1	2	2	1	0	0	2	-1	2	1	0	1
40%	0	2	2	0	0	1	2	3	2	1	0	0
50%	0	2	1	1	2	1	3	2	2	1	1	0
60%	0	2	3	2	1	2	3	0	1	1	1	0
70%	0	3	2	1	3	2	3	1	1	1	1	0
80%	0	3	1	1	3	3	3	2	1	1	1	0
90%	0	2	0	0	3	5	1	1	0	1	0	0
Long Term												
Full Simulation Period ^b	1	2	1	1	2	2	2	0	1	2	1	1
Water Year Types ^c												
Wet (32%)	0	2	1	2	4	3	1	0	0	1	1	0
Above Normal (16%)	1	2	1	0	4	6	4	2	2	1	1	0
Below Normal (13%)	1	2	1	2	4	7	4	2	2	2	0	0
Dry (24%)	2	3	2	1	-1	0	1	-1	2	3	1	1
Critical (15%)	2	3	1	-1	0	-2	-1	-6	0	5	4	2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.


c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1
2


B.15. San Joaquin River at Vernalis Salinity

Figure 6E.B.15.1. San Joaquin River at Vernalis Salinity, Electrical Conductivity, October

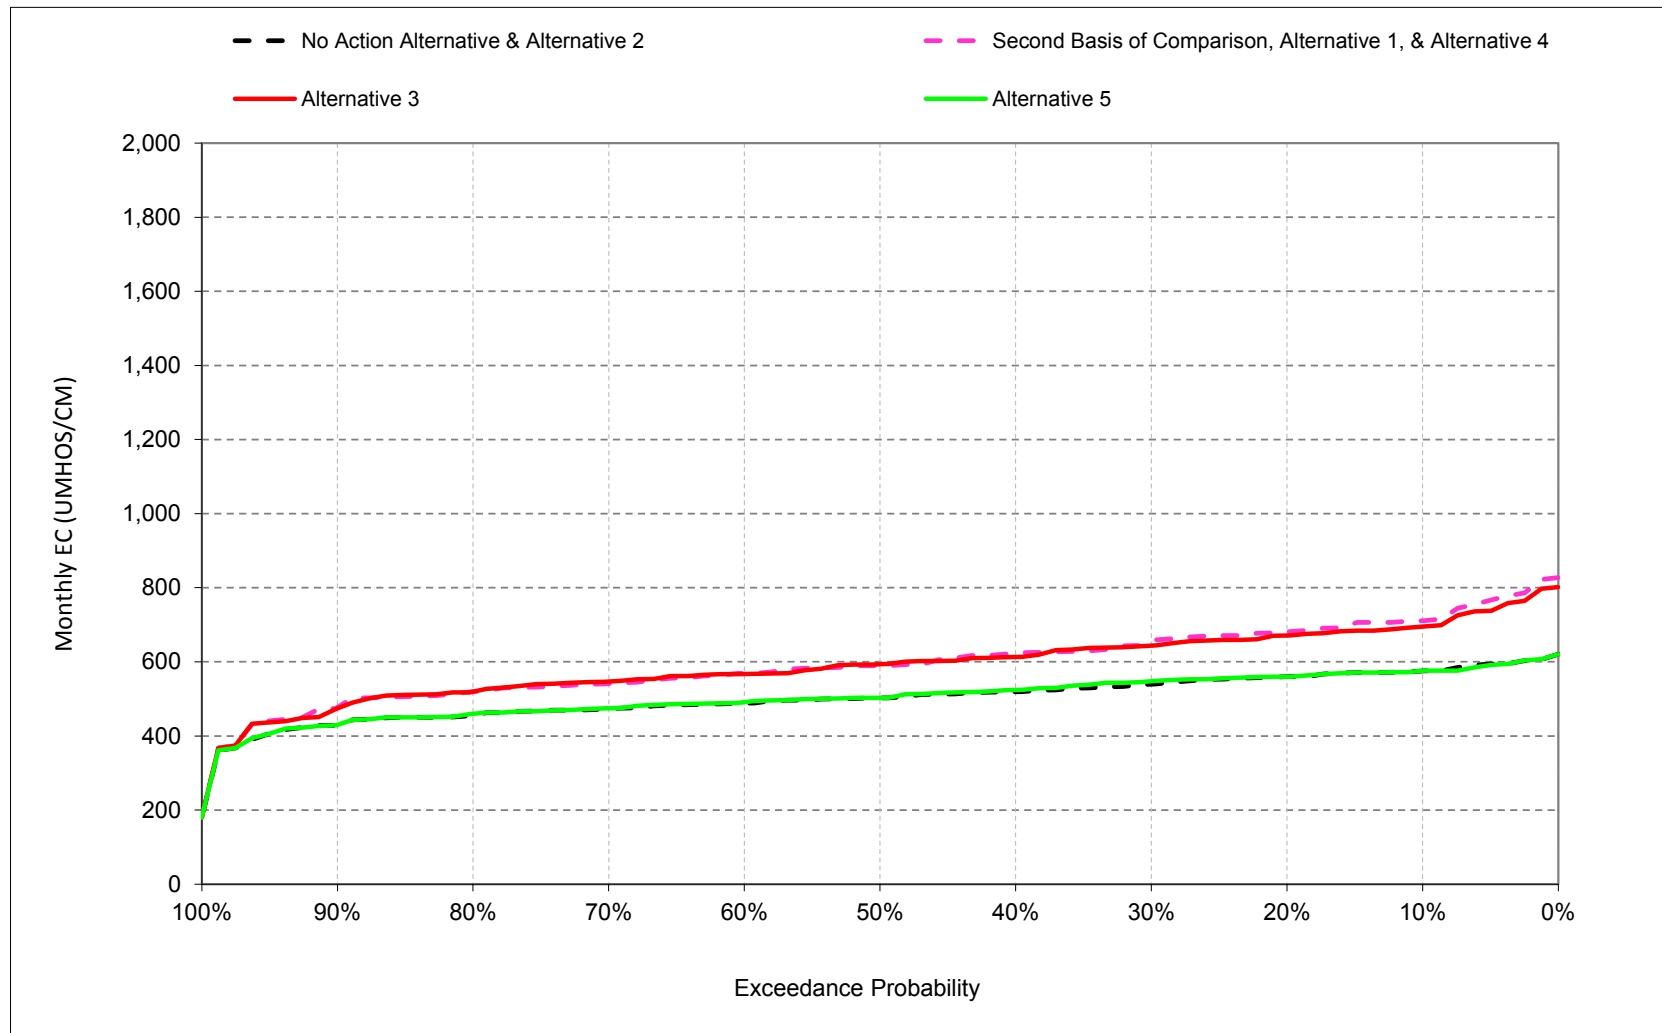


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.15.2. San Joaquin River at Vernalis Salinity, Electrical Conductivity, November

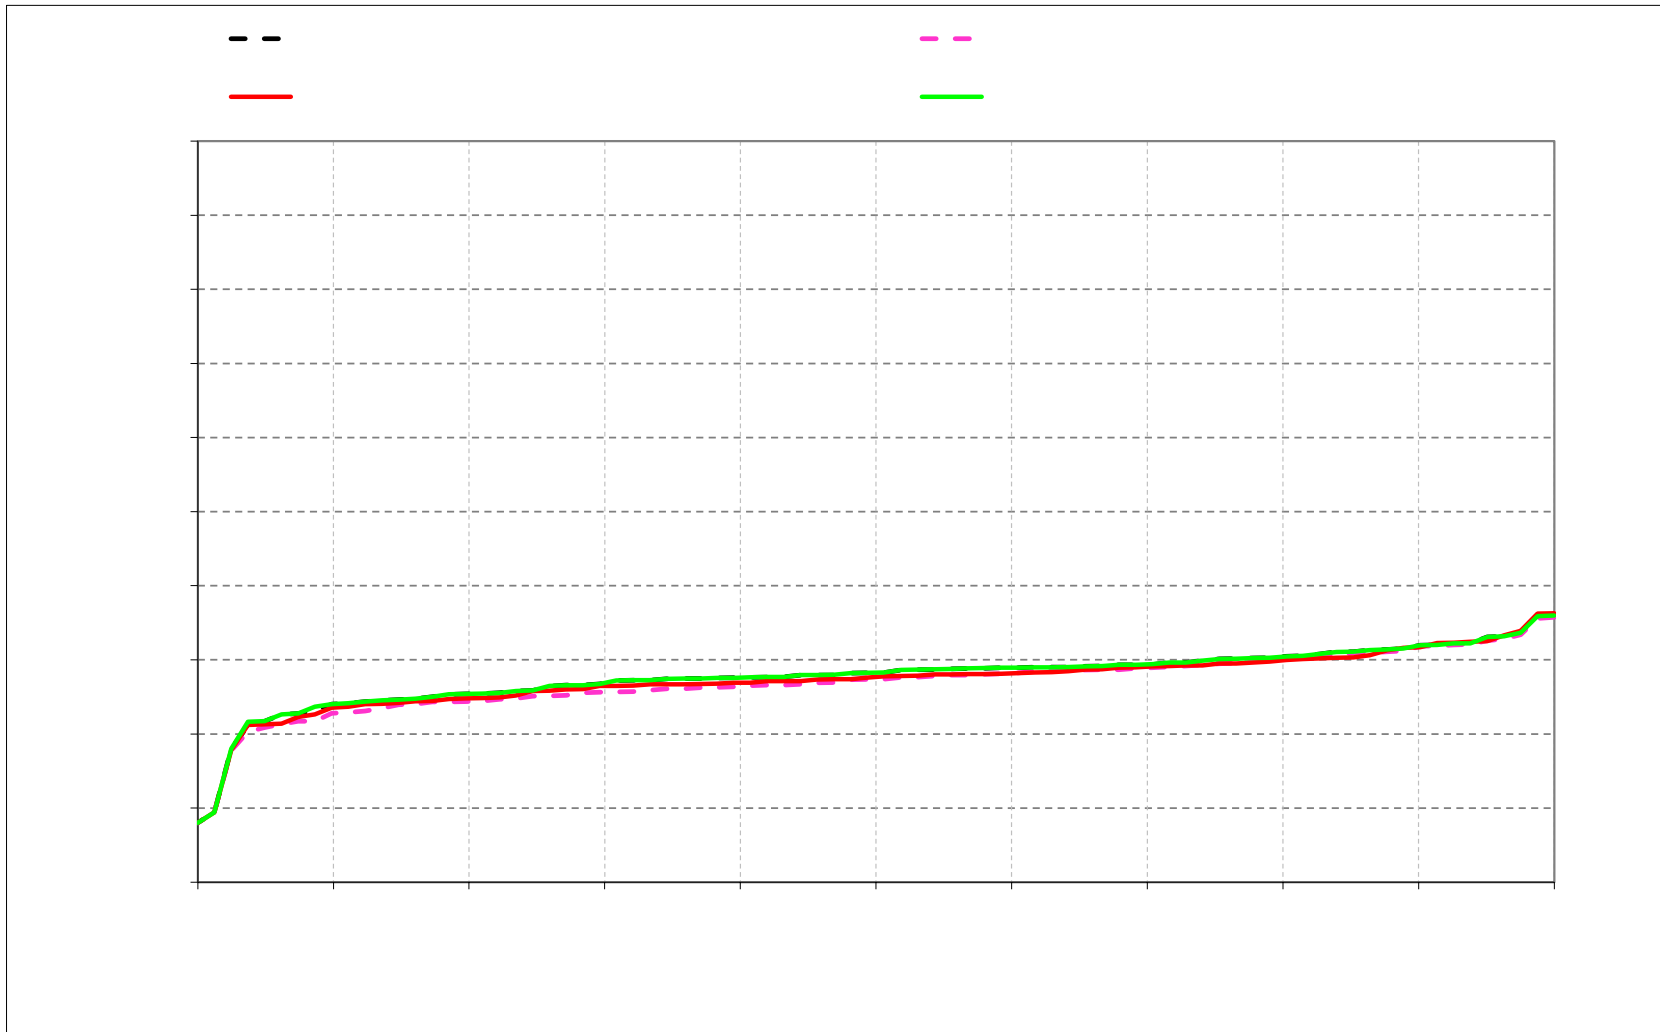


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.15.3. San Joaquin River at Vernalis Salinity, Electrical Conductivity, December

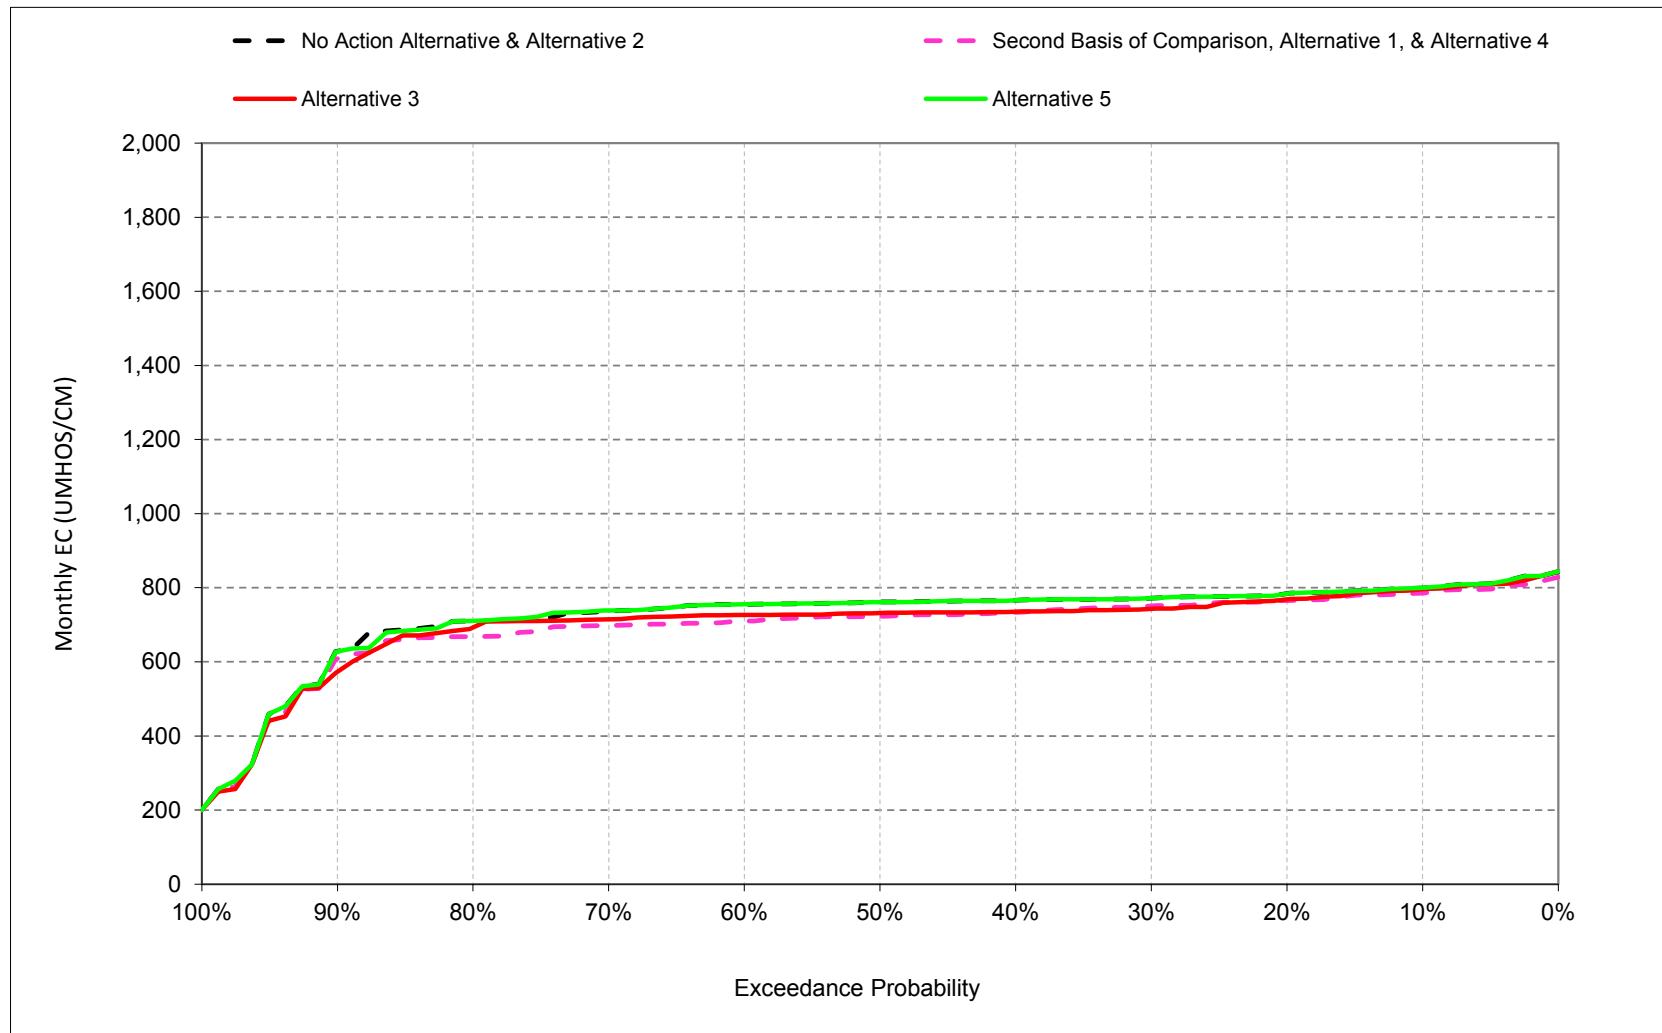


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.15.4. San Joaquin River at Vernalis Salinity, Electrical Conductivity, January

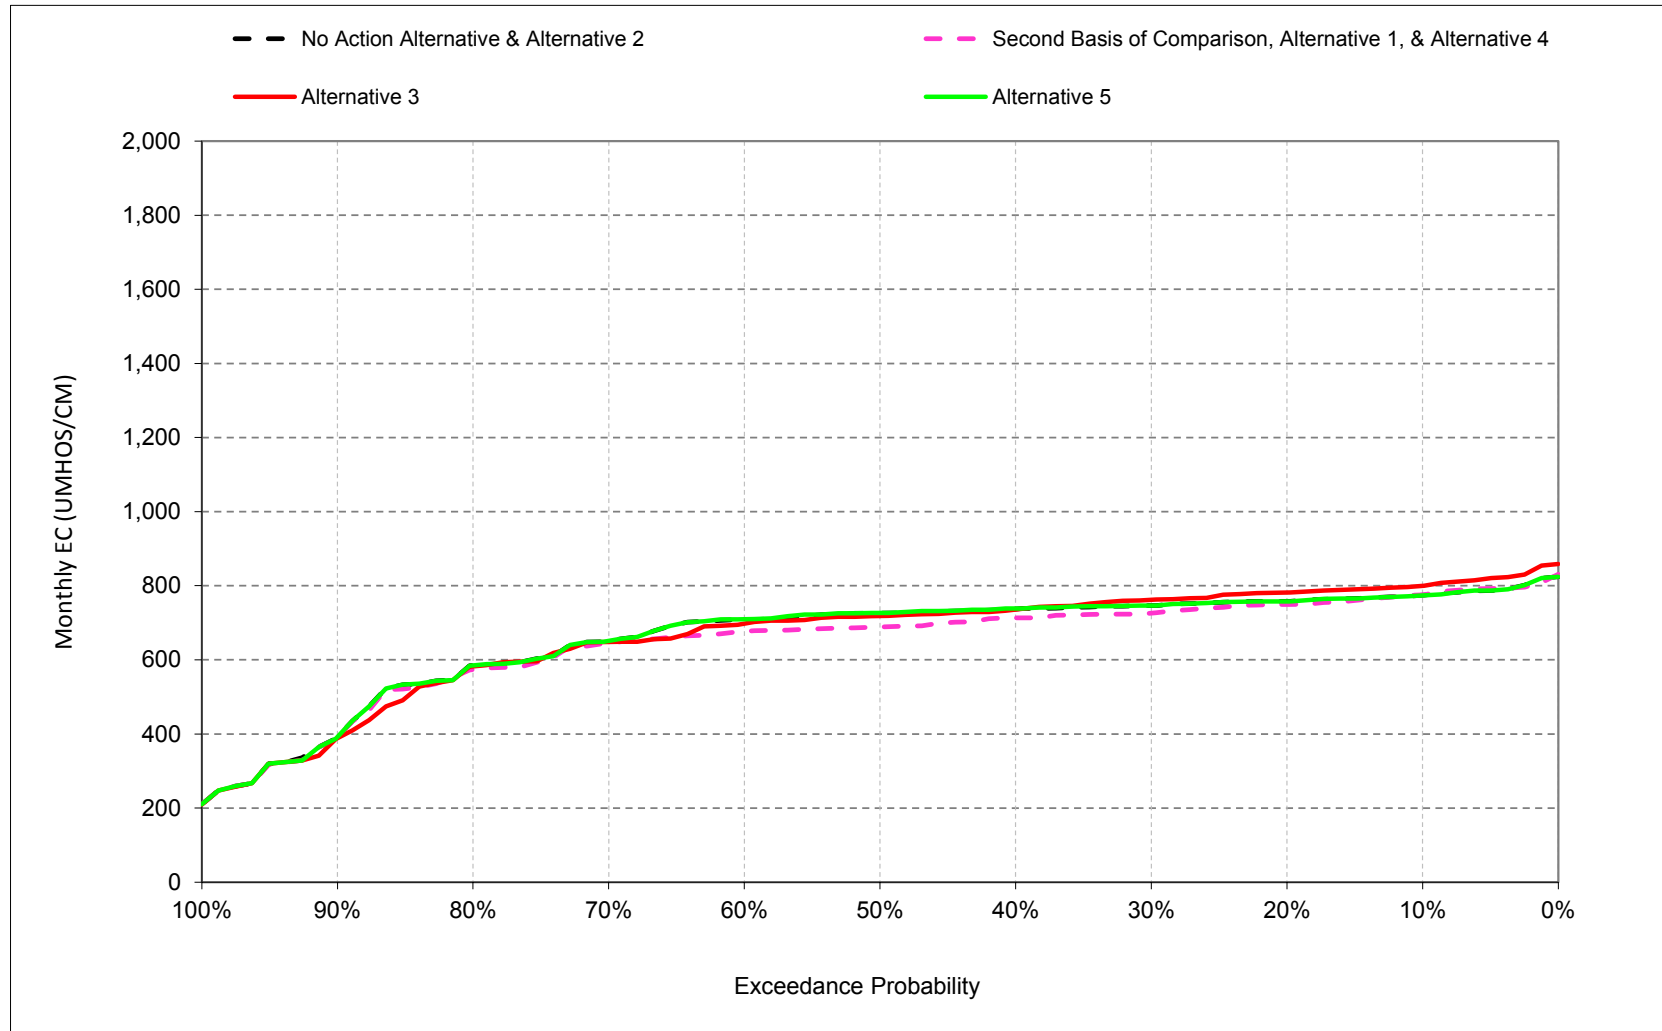


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.15.5. San Joaquin River at Vernalis Salinity, Electrical Conductivity, February

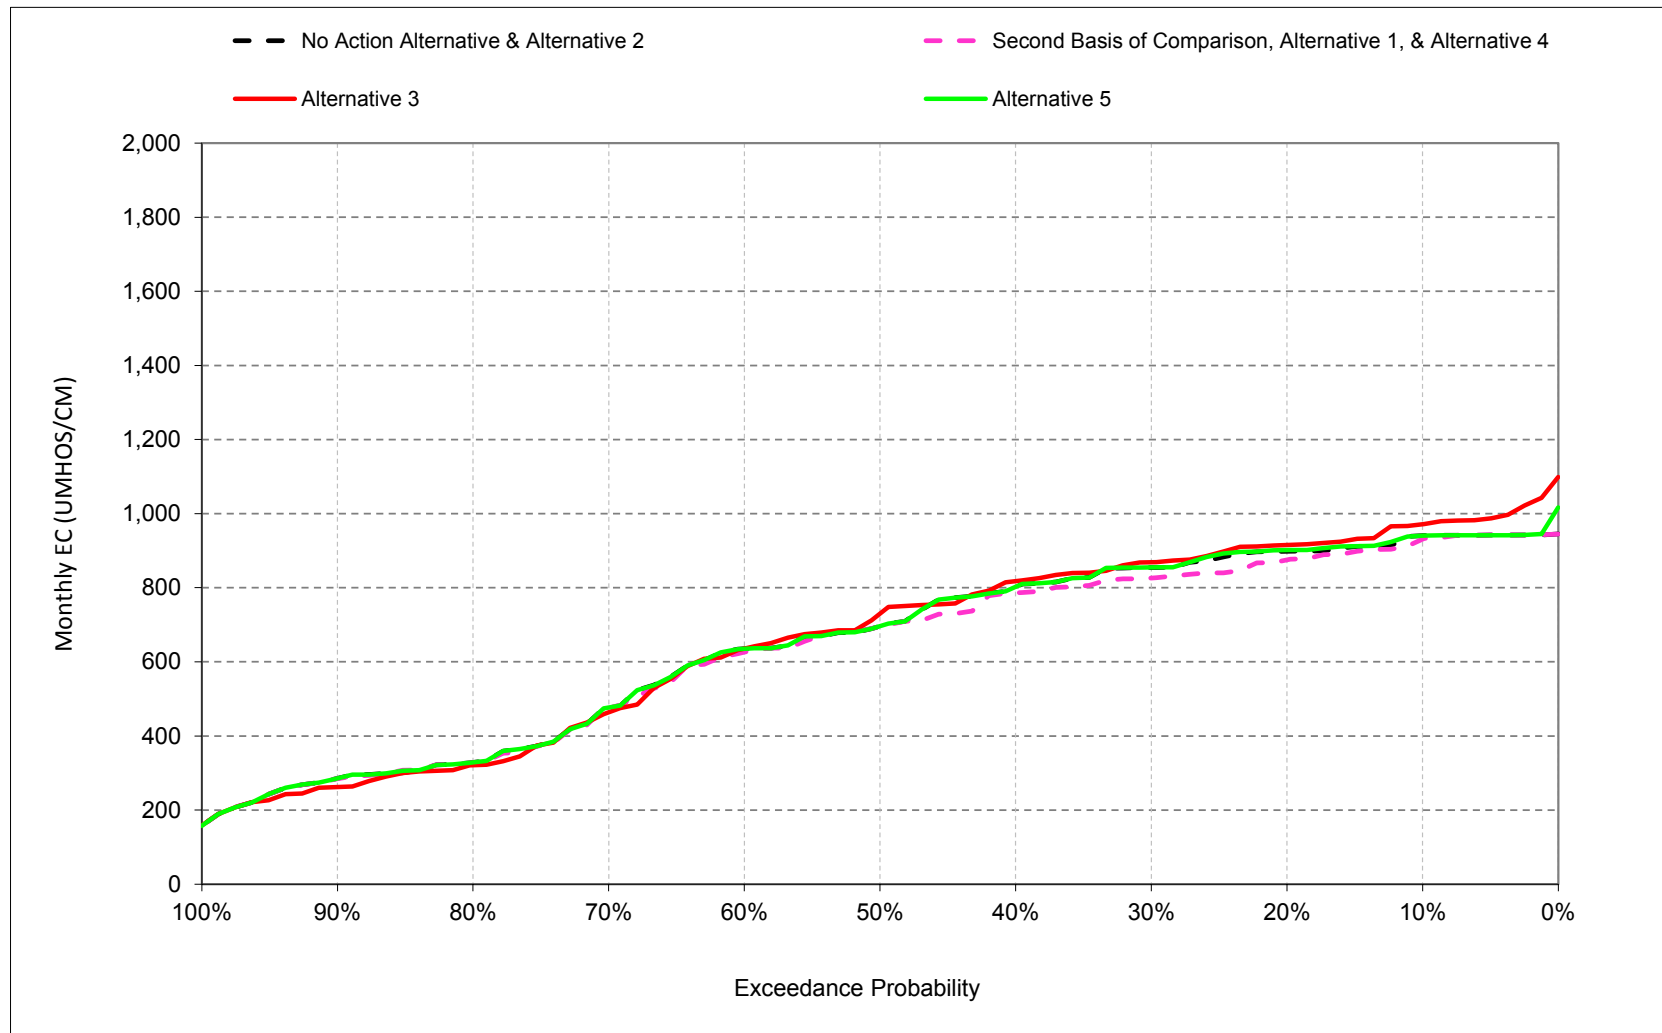


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.15.6. San Joaquin River at Vernalis Salinity, Electrical Conductivity, March

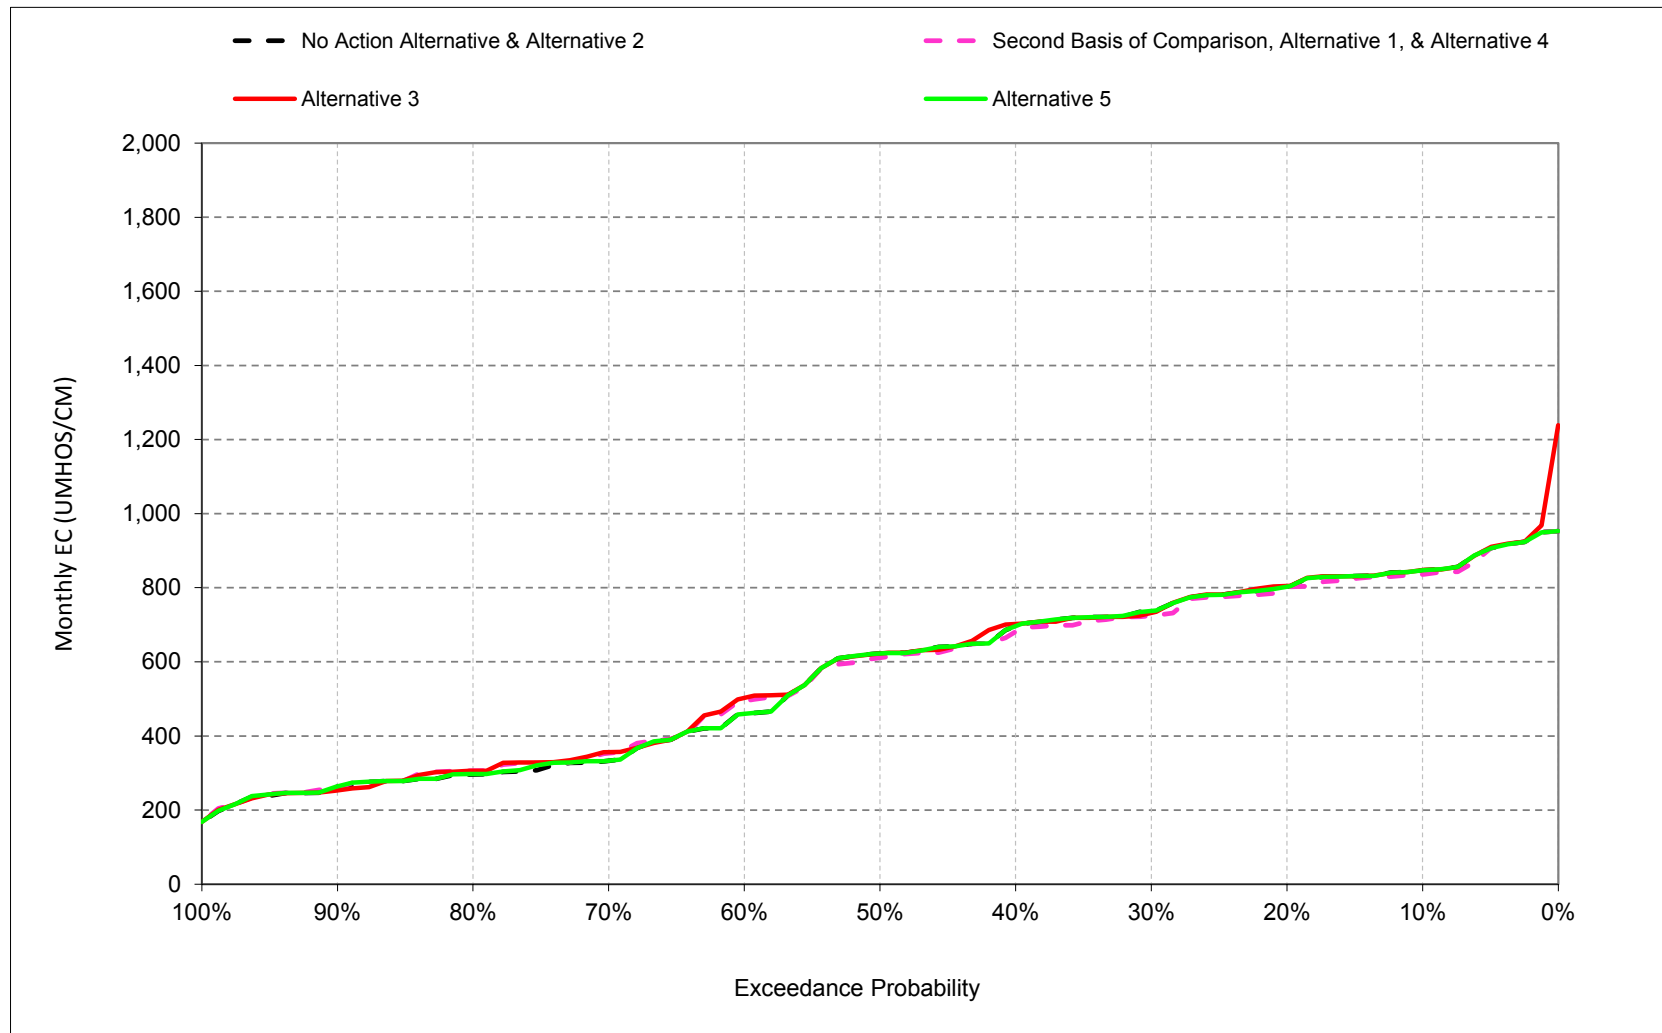


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.15.7. San Joaquin River at Vernalis Salinity, Electrical Conductivity, April

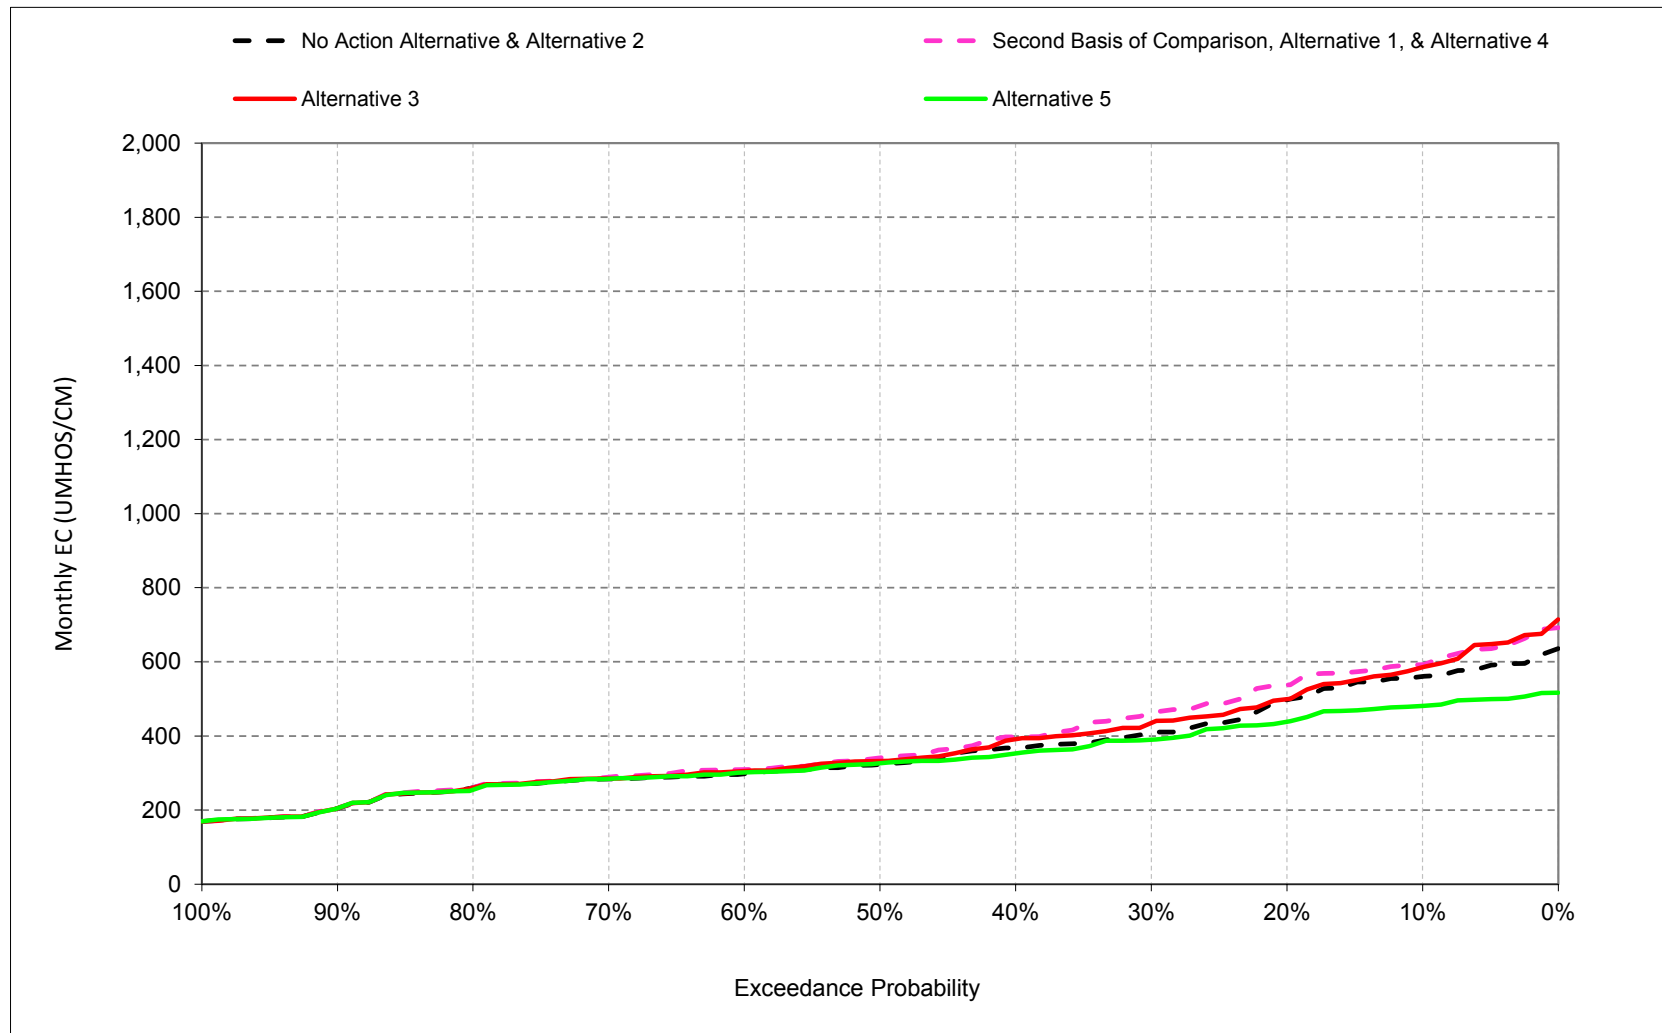


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.15.8. San Joaquin River at Vernalis Salinity, Electrical Conductivity, May

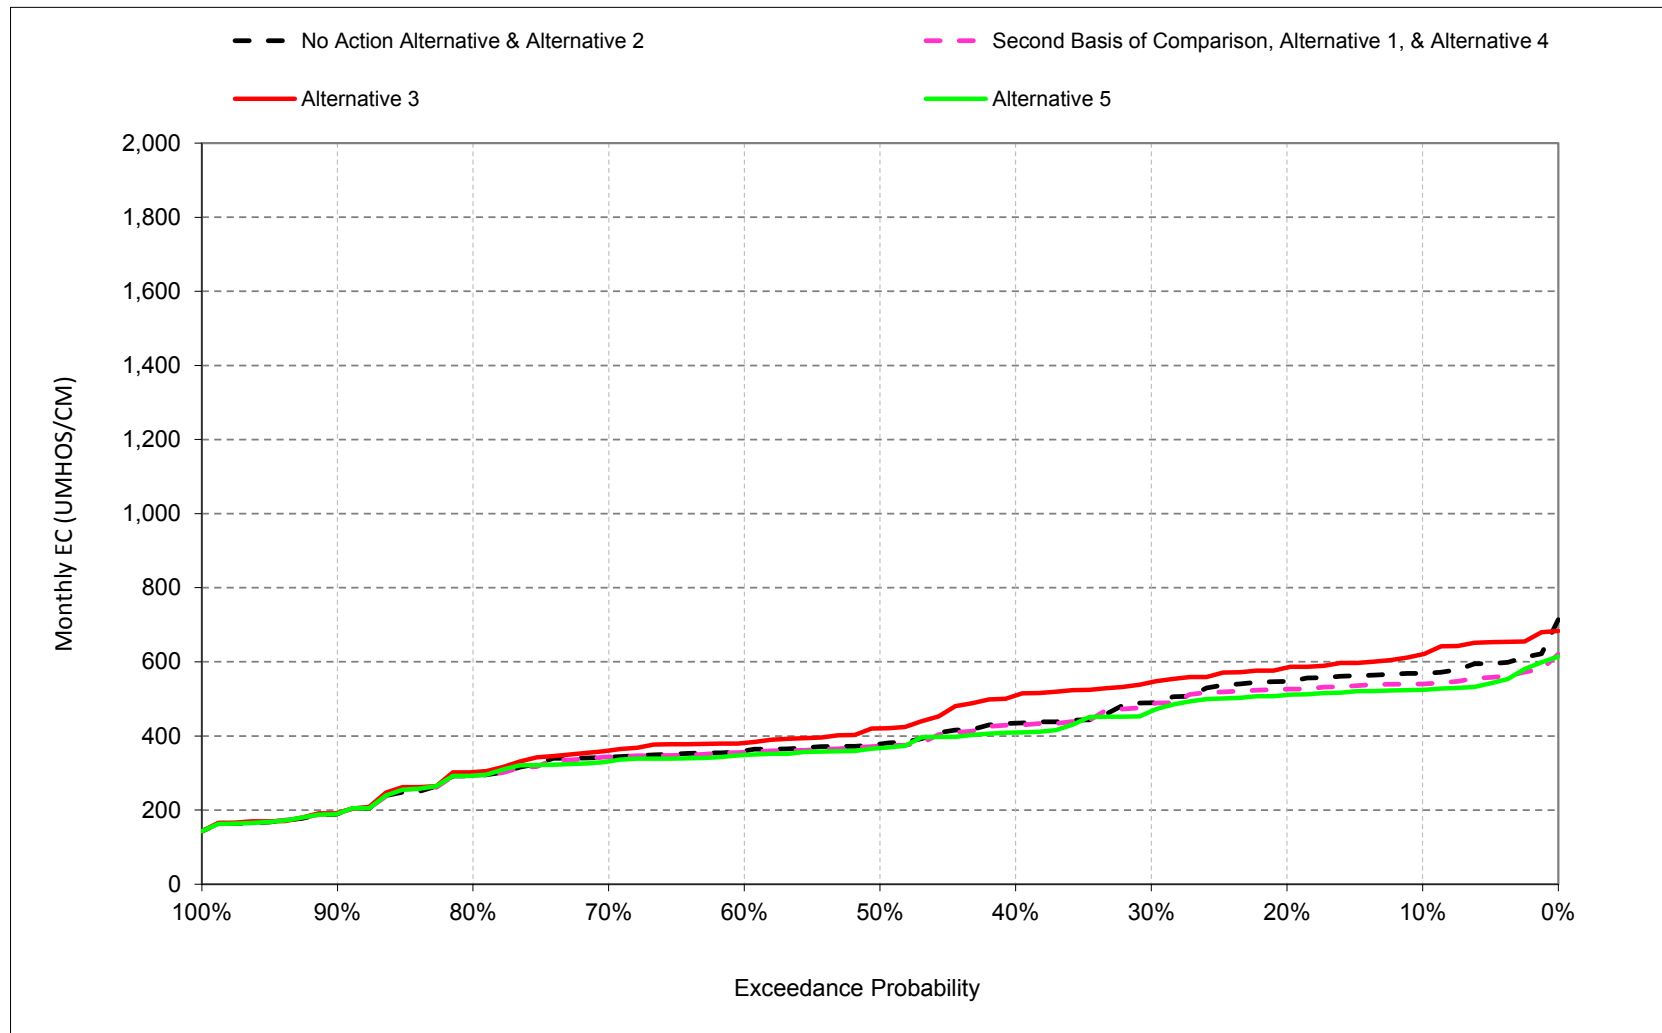


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.15.9. San Joaquin River at Vernalis Salinity, Electrical Conductivity, June

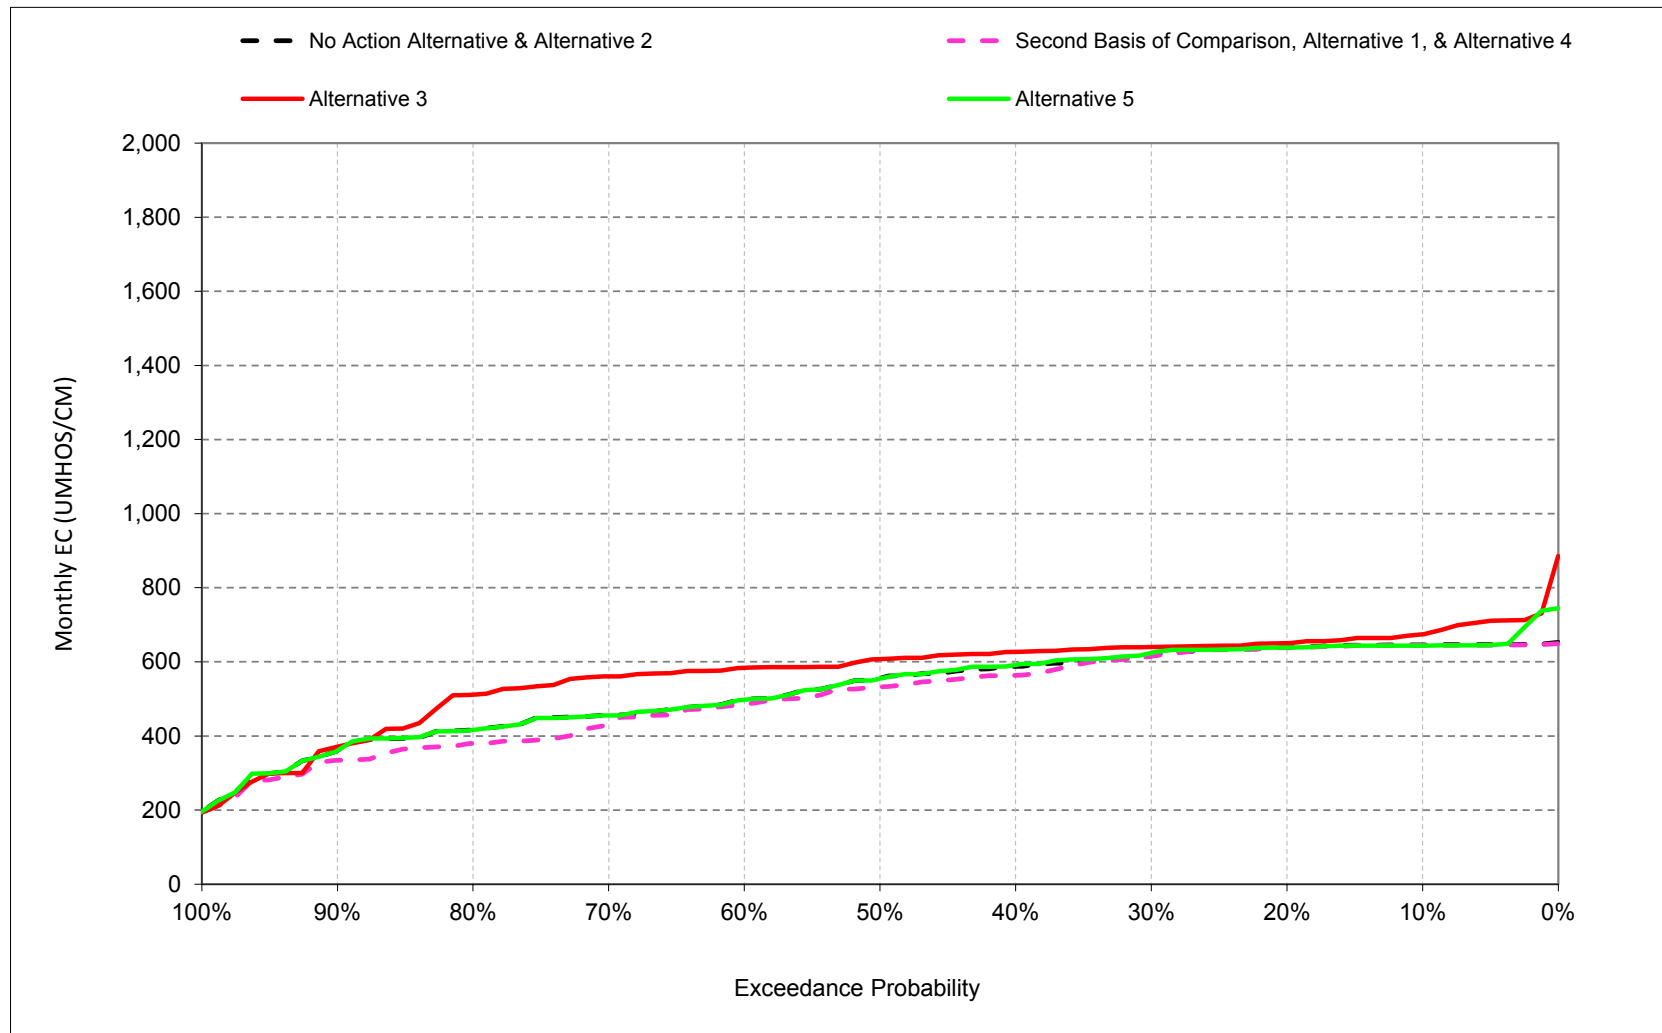


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.15.10. San Joaquin River at Vernalis Salinity, Electrical Conductivity, July

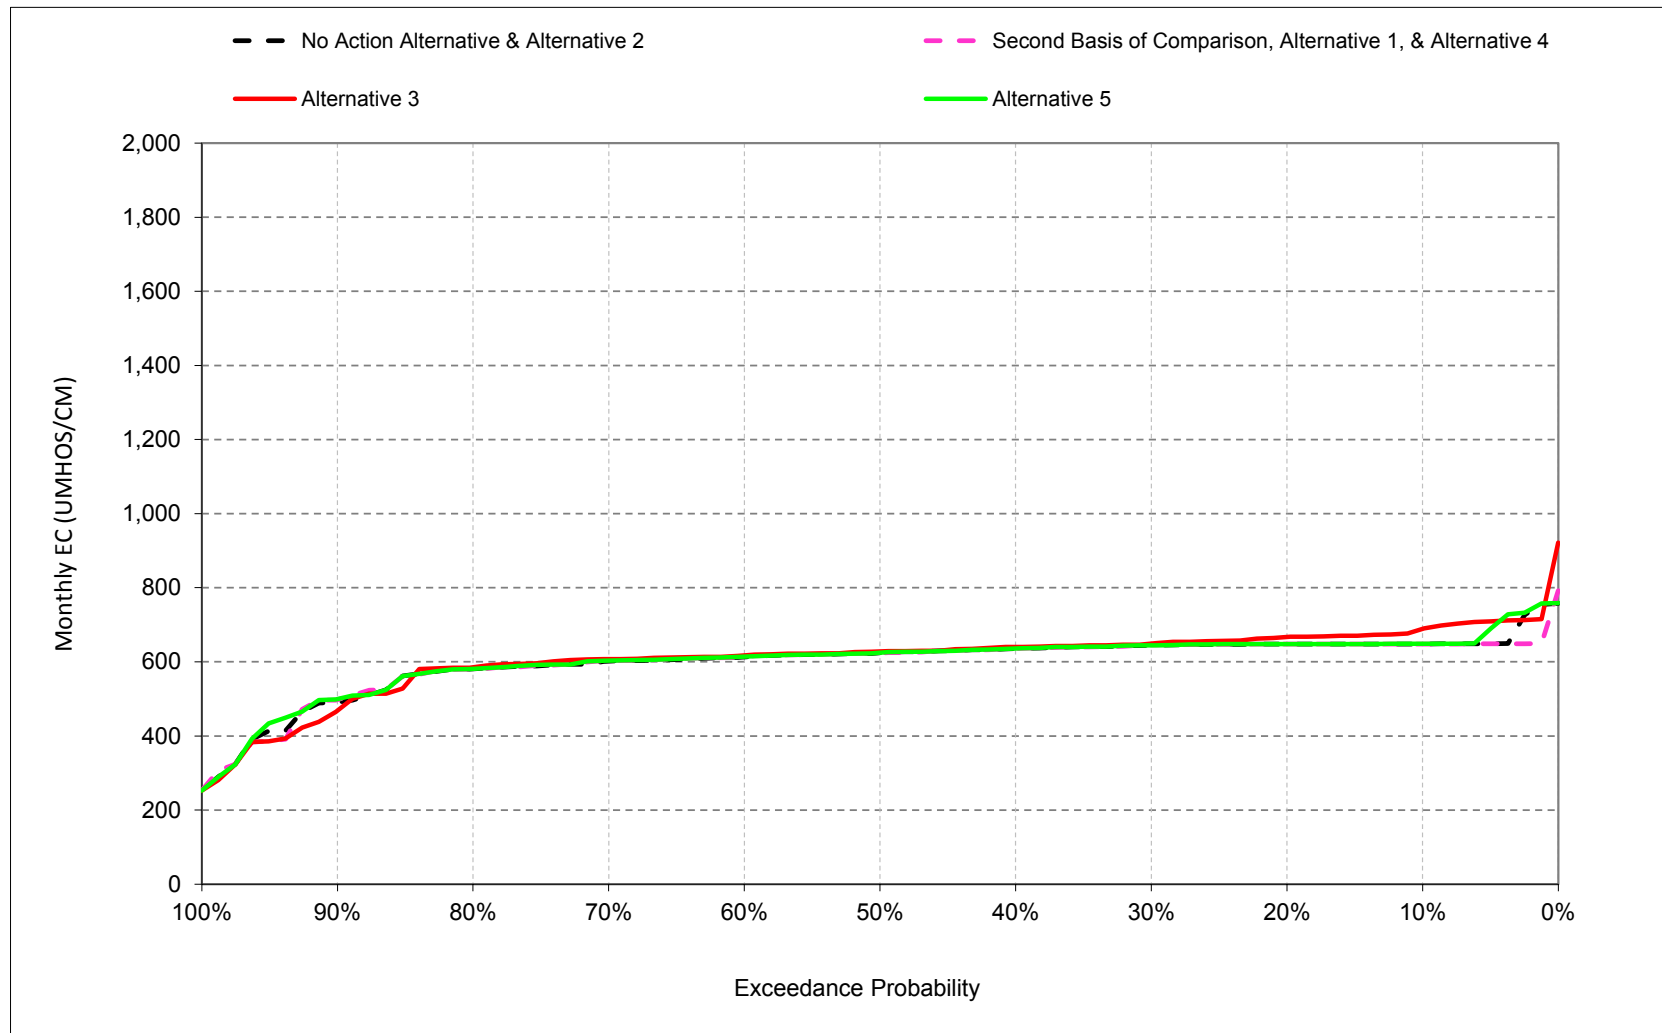


Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.15.11. San Joaquin River at Vernalis Salinity, Electrical Conductivity, August

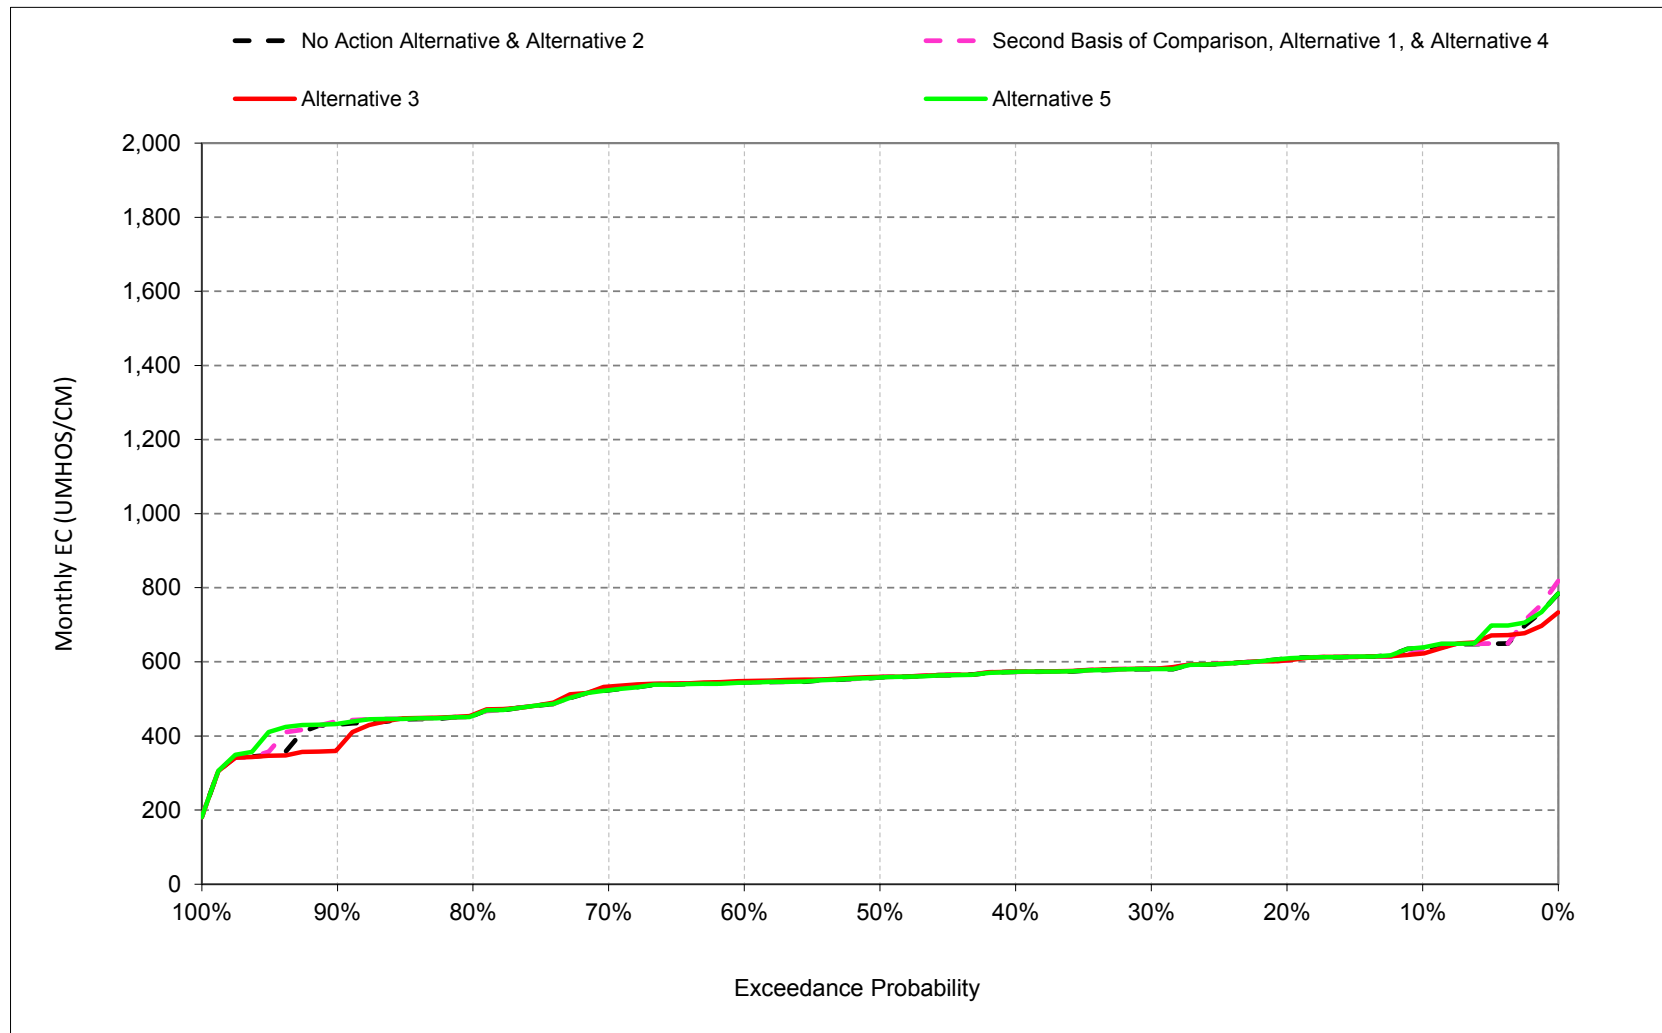

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Figure 6E.B.15.12. San Joaquin River at Vernalis Salinity, Electrical Conductivity, September

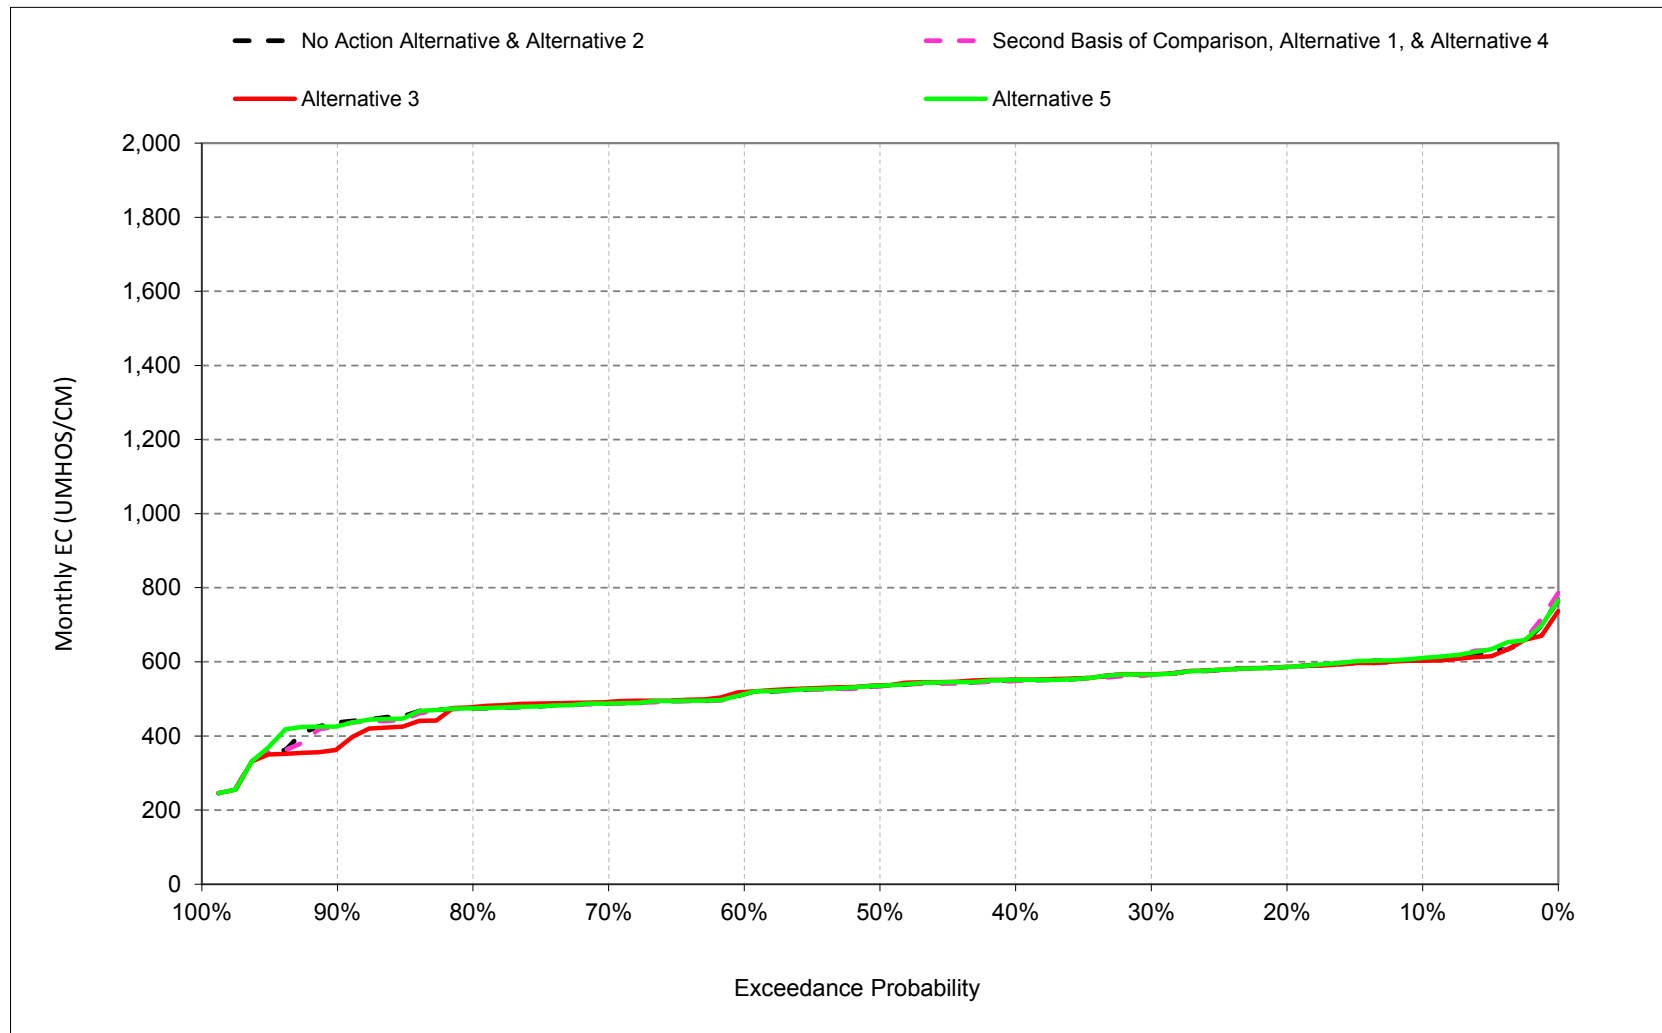

Notes: 1) Exceedance probability is defined as the probability a given value will be exceeded in any one year. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.15.1. San Joaquin River at Vernalis, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	575	639	800	774	941	847	561	569	646	648	636	606
20%	560	608	784	758	898	803	498	547	639	648	609	586
30%	540	587	772	746	855	737	408	489	616	645	580	568
40%	519	579	766	737	802	696	368	435	588	636	573	551
50%	503	565	761	726	697	623	323	378	556	624	558	538
60%	488	552	755	709	635	460	298	360	498	613	544	521
70%	474	538	736	651	477	333	284	343	456	602	523	489
80%	456	509	710	585	329	296	261	293	417	581	455	476
90%	430	481	629	392	286	263	205	190	361	491	431	441
Long Term												
Full Simulation Period ^b	503	554	721	660	647	564	360	401	521	599	539	526
Water Year Types^c												
Wet (23%)	427	465	633	546	508	425	299	351	476	574	512	490
Above Normal (24%)	479	530	716	673	637	546	366	414	546	614	541	537
Below Normal (10%)	509	583	764	717	719	630	323	375	510	594	520	519
Dry (16%)	533	585	726	669	639	535	350	366	489	584	525	499
Critical (27%)	571	627	784	721	754	694	425	462	558	617	575	564

Alternative 1												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	711	635	785	776	931	836	592	540	645	648	635	603
20%	681	603	766	750	875	799	537	526	638	648	604	586
30%	655	578	751	726	826	724	461	485	615	645	582	568
40%	623	564	734	713	786	681	398	429	564	636	573	551
50%	590	548	723	689	695	611	341	373	532	624	559	538
60%	569	529	710	677	626	494	309	356	485	614	545	521
70%	541	513	698	645	477	353	289	344	434	603	529	488
80%	520	488	668	574	328	306	260	294	380	581	454	478
90%	477	456	609	391	285	258	205	192	335	498	440	437
Long Term												
Full Simulation Period ^b	595	539	695	646	636	564	383	391	505	597	542	525
Water Year Types^c												
Wet (23%)	475	442	598	525	490	431	325	353	439	574	514	489
Above Normal (24%)	549	512	686	654	622	543	383	402	534	614	541	532
Below Normal (10%)	604	561	727	692	702	627	353	369	496	590	520	518
Dry (16%)	641	573	705	659	635	533	370	356	473	580	533	500
Critical (27%)	715	621	770	719	753	692	452	442	556	614	579	565

Alternative 1 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	136	-4	-14	1	-10	-11	31	-28	-1	0	-1	-3
20%	121	-6	-18	-8	-23	-3	40	-21	-1	0	-5	0
30%	115	-9	-21	-20	-29	-13	53	-4	0	1	2	0
40%	104	-14	-33	-24	-16	-15	30	-5	-24	0	0	0
50%	87	-17	-39	-37	-1	-12	18	-5	-24	-1	1	0
60%	81	-24	-45	-32	-9	34	12	-4	-13	1	1	0
70%	68	-25	-38	-5	0	20	6	0	-22	1	6	-1
80%	63	-21	-42	-11	-1	10	0	0	-38	0	0	2
90%	48	-25	-20	-1	-1	-5	1	2	-26	7	8	-4
Long Term												
Full Simulation Period ^b	93	-15	-27	-14	-11	0	24	-10	-16	-2	3	-1
Water Year Types^c												
Wet (23%)	48	-23	-36	-21	-19	6	26	2	-37	0	3	-1
Above Normal (24%)	70	-17	-30	-20	-15	-3	17	-12	-12	0	-1	-5
Below Normal (10%)	94	-22	-37	-25	-17	-3	30	-7	-14	-4	0	-1
Dry (16%)	108	-11	-21	-10	-5	-2	19	-10	-16	-4	8	1
Critical (27%)	144	-6	-15	-2	-1	-1	27	-21	-2	-3	4	2

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
^b Based on the 82-year simulation period
^c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.15.2. San Joaquin River at Vernalis, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	575	639	800	774	941	847	561	569	646	648	636	606
20%	560	608	784	758	898	803	498	547	639	648	609	586
30%	540	587	772	746	855	737	408	489	616	645	580	568
40%	519	579	766	737	802	696	368	435	588	636	573	551
50%	503	565	761	726	697	623	323	378	556	624	558	538
60%	488	552	755	709	635	460	298	360	498	613	544	521
70%	474	538	736	651	477	333	284	343	456	602	523	489
80%	456	509	710	585	329	296	261	293	417	581	455	476
90%	430	481	629	392	286	263	205	190	361	491	431	441
Long Term												
Full Simulation Period ^b	503	554	721	660	647	564	360	401	521	599	539	526
Water Year Types ^c												
Wet (23%)	427	465	633	546	508	425	299	351	476	574	512	490
Above Normal (24%)	479	530	716	673	637	546	366	414	546	614	541	537
Below Normal (10%)	509	583	764	717	719	630	323	375	510	594	520	519
Dry (16%)	533	585	726	669	639	535	350	366	489	584	525	499
Critical (27%)	571	627	784	721	754	694	425	462	558	617	575	564

Alternative 3

Alternative 3												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	695	634	796	800	972	848	586	620	674	689	622	603
20%	671	599	768	781	916	805	499	585	650	667	604	586
30%	644	582	743	762	869	732	435	545	640	649	582	568
40%	613	564	735	736	818	702	391	509	627	640	573	552
50%	594	554	732	718	730	622	332	421	607	628	559	540
60%	567	538	727	698	636	503	305	381	584	617	548	522
70%	547	530	715	648	464	356	285	361	561	607	533	495
80%	519	496	693	582	321	306	260	302	512	586	457	482
90%	475	471	573	389	262	253	205	193	371	469	364	400
Long Term												
Full Simulation Period ^b	590	544	701	663	657	573	374	434	569	607	536	521
Water Year Types ^c												
Wet (23%)	477	455	609	526	478	437	321	395	548	582	511	490
Above Normal (24%)	547	519	695	670	634	547	369	436	587	625	537	528
Below Normal (10%)	608	568	736	723	733	645	337	413	536	591	509	508
Dry (16%)	635	572	702	684	666	535	361	395	525	581	524	497
Critical (27%)	699	622	773	742	802	711	443	493	605	633	574	561

Alternative 3 minus No Action Alternative

Alternative 3 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	120	-5	-3	26	31	1	25	51	28	40	-14	-3
20%	111	-9	-16	23	17	2	2	37	11	19	-5	0
30%	104	-6	-29	16	14	-5	27	56	24	5	1	0
40%	94	-15	-31	-1	16	5	23	74	39	5	0	1
50%	91	-11	-29	-8	33	0	9	43	51	4	1	2
60%	79	-14	-29	-11	1	43	7	22	86	4	4	1
70%	73	-8	-22	-3	-13	23	2	18	104	6	10	6
80%	63	-12	-17	-3	-8	10	-1	9	94	5	3	6
90%	45	-10	-55	-3	-23	-10	0	3	10	-22	-67	-41
Long Term												
Full Simulation Period ^b	88	-10	-20	3	10	9	14	32	48	8	-3	-4
Water Year Types ^c												
Wet (23%)	50	-10	-24	-20	-30	12	22	44	72	8	0	0
Above Normal (24%)	68	-11	-21	-4	-3	1	3	22	41	11	-4	-9
Below Normal (10%)	98	-15	-27	6	13	15	14	38	26	-2	-10	-11
Dry (16%)	102	-13	-24	15	27	0	11	30	36	-3	-1	-2
Critical (27%)	128	-5	-12	21	48	17	18	31	47	16	-1	-2

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period

^c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.15.3. San Joaquin River at Vernalis, Monthly EC

No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	575	639	800	774	941	847	561	569	646	648	636	606
20%	560	608	784	758	898	803	498	547	639	648	609	586
30%	540	587	772	746	855	737	408	489	616	645	580	568
40%	519	579	766	737	802	696	368	435	588	636	573	551
50%	503	565	761	726	697	623	323	378	556	624	558	538
60%	488	552	755	709	635	460	298	360	498	613	544	521
70%	474	538	736	651	477	333	284	343	456	602	523	489
80%	456	509	710	585	329	296	261	293	417	581	455	476
90%	430	481	629	392	286	263	205	190	361	491	431	441
Long Term												
Full Simulation Period ^b	503	554	721	660	647	564	360	401	521	599	539	526
Water Year Types ^c												
Wet (23%)	427	465	633	546	508	425	299	351	476	574	512	490
Above Normal (24%)	479	530	716	673	637	546	366	414	546	614	541	537
Below Normal (10%)	509	583	764	717	719	630	323	375	510	594	520	519
Dry (16%)	533	585	726	669	639	535	350	366	489	584	525	499
Critical (27%)	571	627	784	721	754	694	425	462	558	617	575	564

Alternative 5												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	576	638	800	774	941	847	481	525	644	649	639	611
20%	560	608	784	758	901	803	438	511	639	648	609	586
30%	548	588	772	746	855	737	390	467	624	645	580	568
40%	524	579	766	739	802	696	353	410	591	636	573	551
50%	503	565	761	727	697	623	326	367	555	624	558	538
60%	491	552	755	710	635	460	302	349	498	614	544	521
70%	475	538	739	651	477	333	284	331	455	603	524	489
80%	460	509	710	585	329	297	255	293	416	581	455	476
90%	430	481	628	392	286	264	205	190	361	500	433	437
Long Term												
Full Simulation Period ^b	504	554	721	661	649	565	339	383	525	602	543	527
Water Year Types ^c												
Wet (23%)	428	466	633	547	512	425	292	345	478	574	512	489
Above Normal (24%)	481	530	716	674	638	546	347	394	546	614	541	536
Below Normal (10%)	512	583	764	717	720	630	327	377	515	598	531	521
Dry (16%)	537	585	726	670	640	539	329	348	494	589	533	507
Critical (27%)	572	627	784	721	757	694	382	427	567	623	581	566

Alternative 5 minus No Action Alternative												
Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	1	-1	0	0	0	0	-80	-44	-2	0	3	5
20%	0	0	0	0	3	0	-59	-37	0	0	0	0
30%	8	1	0	0	0	0	-18	-23	8	0	0	0
40%	5	0	0	2	0	0	-15	-25	4	0	0	0
50%	0	0	0	1	0	0	3	-11	-1	0	0	0
60%	3	0	0	1	0	0	4	-11	0	1	0	0
70%	1	0	2	0	0	0	0	-12	-1	1	0	0
80%	3	0	0	0	0	1	-6	0	-1	0	0	0
90%	0	0	-1	0	0	1	0	0	0	9	2	-4
Long Term												
Full Simulation Period ^b	2	0	0	0	2	1	-21	-18	4	3	4	2
Water Year Types ^c												
Wet (23%)	1	1	-1	2	3	0	-7	-5	2	1	1	-1
Above Normal (24%)	2	0	0	0	0	0	-19	-20	-1	0	0	-1
Below Normal (10%)	3	0	0	0	0	0	4	1	5	4	11	2
Dry (16%)	4	0	0	0	0	4	-22	-17	5	6	8	8
Critical (27%)	1	0	0	0	3	0	-43	-36	9	6	5	3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period

c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.15.4. San Joaquin River at Vernalis, Monthly EC

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	711	635	785	776	931	836	592	540	645	648	635	603
20%	681	603	766	750	875	799	537	526	638	648	604	586
30%	655	578	751	726	826	724	461	485	615	645	582	568
40%	623	564	734	713	786	681	398	429	564	636	573	551
50%	590	548	723	689	695	611	341	373	532	624	559	538
60%	569	529	710	677	626	494	309	356	485	614	545	521
70%	541	513	698	645	477	353	289	344	434	603	529	488
80%	520	488	668	574	328	306	260	294	380	581	454	478
90%	477	456	609	391	285	258	205	192	335	498	440	437
Long Term												
Full Simulation Period ^b	595	539	695	646	636	564	383	391	505	597	542	525
Water Year Types ^c												
Wet (23%)	475	442	598	525	490	431	325	353	439	574	514	489
Above Normal (24%)	549	512	686	654	622	543	383	402	534	614	541	532
Below Normal (10%)	604	561	727	692	702	627	353	369	496	590	520	518
Dry (16%)	641	573	705	659	635	533	370	356	473	580	533	500
Critical (27%)	715	621	770	719	753	692	452	442	556	614	579	565

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance ^a												
10%	575	639	800	774	941	847	561	569	646	648	636	606
20%	560	608	784	758	898	803	498	547	639	648	609	586
30%	540	587	772	746	855	737	408	489	616	645	580	568
40%	519	579	766	737	802	696	368	435	588	636	573	551
50%	503	565	761	726	697	623	323	378	556	624	558	538
60%	488	552	755	709	635	460	298	360	498	613	544	521
70%	474	538	736	651	477	333	284	343	456	602	523	489
80%	456	509	710	585	329	296	261	293	417	581	455	476
90%	430	481	629	392	286	263	205	190	361	491	431	441
Long Term												
Full Simulation Period ^b	503	554	721	660	647	564	360	401	521	599	539	526
Water Year Types ^c												
Wet (23%)	427	465	633	546	508	425	299	351	476	574	512	490
Above Normal (24%)	479	530	716	673	637	546	366	414	546	614	541	537
Below Normal (10%)	509	583	764	717	719	630	323	375	510	594	520	519
Dry (16%)	533	585	726	669	639	535	350	366	489	584	525	499
Critical (27%)	571	627	784	721	754	694	425	462	558	617	575	564

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative minus Second Basis of Comparison												
Probability of Exceedance ^a												
10%	-136	4	14	-1	10	11	-31	28	1	0	1	3
20%	-121	6	18	8	23	3	-40	21	1	0	5	0
30%	-115	9	21	20	29	13	-53	4	0	-1	-2	0
40%	-104	14	33	24	16	15	-30	5	24	0	0	0
50%	-87	17	39	37	1	12	-18	5	24	1	-1	0
60%	-81	24	45	32	9	-34	-12	4	13	-1	-1	0
70%	-68	25	38	5	0	-20	-6	0	22	-1	-6	1
80%	-63	21	42	11	1	-10	0	0	38	0	0	-2
90%	-48	25	20	1	1	5	-1	-2	26	-7	-8	4
Long Term												
Full Simulation Period ^b	-93	15	27	14	11	0	-24	10	16	2	-3	1
Water Year Types ^c												
Wet (23%)	-48	23	36	21	19	-6	-26	-2	37	0	-3	1
Above Normal (24%)	-70	17	30	20	15	3	-17	12	12	0	1	5
Below Normal (10%)	-94	22	37	25	17	3	-30	7	14	4	0	1
Dry (16%)	-108	11	21	10	5	2	-19	10	16	4	-8	-1
Critical (27%)	-144	6	15	2	1	1	-27	21	2	3	-4	-2

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period

^c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.15.5. San Joaquin River at Vernalis, Monthly EC

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	711	635	785	776	931	836	592	540	645	648	635	603
20%	681	603	766	750	875	799	537	526	638	648	604	586
30%	655	578	751	726	826	724	461	485	615	645	582	568
40%	623	564	734	713	786	681	398	429	564	636	573	551
50%	590	548	723	689	695	611	341	373	532	624	559	538
60%	569	529	710	677	626	494	309	356	485	614	545	521
70%	541	513	698	645	477	353	289	344	434	603	529	488
80%	520	488	668	574	328	306	260	294	380	581	454	478
90%	477	456	609	391	285	258	205	192	335	498	440	437
Long Term												
Full Simulation Period ^b	595	539	695	646	636	564	383	391	505	597	542	525
Water Year Types ^c												
Wet (23%)	475	442	598	525	490	431	325	353	439	574	514	489
Above Normal (24%)	549	512	686	654	622	543	383	402	534	614	541	532
Below Normal (10%)	604	561	727	692	702	627	353	369	496	590	520	518
Dry (16%)	641	573	705	659	635	533	370	356	473	580	533	500
Critical (27%)	715	621	770	719	753	692	452	442	556	614	579	565

Alternative 3

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	695	634	796	800	972	848	586	620	674	689	622	603
20%	671	599	768	781	916	805	499	585	650	667	604	586
30%	644	582	743	762	869	732	435	545	640	649	582	568
40%	613	564	735	736	818	702	391	509	627	640	573	552
50%	594	554	732	718	730	622	332	421	607	628	559	540
60%	567	538	727	698	636	503	305	381	584	617	548	522
70%	547	530	715	648	464	356	285	361	561	607	533	495
80%	519	496	693	582	321	306	260	302	512	586	457	482
90%	475	471	573	389	262	253	205	193	371	469	364	400
Long Term												
Full Simulation Period ^b	590	544	701	663	657	573	374	434	569	607	536	521
Water Year Types ^c												
Wet (23%)	477	455	609	526	478	437	321	395	548	582	511	490
Above Normal (24%)	547	519	695	670	634	547	369	436	587	625	537	528
Below Normal (10%)	608	568	736	723	733	645	337	413	536	591	509	508
Dry (16%)	635	572	702	684	666	535	361	395	525	581	524	497
Critical (27%)	699	622	773	742	802	711	443	493	605	633	574	561

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-16	-1	11	24	40	11	-7	80	30	40	-13	0
20%	-10	-4	3	32	40	6	-38	58	12	19	0	0
30%	-11	3	-8	36	43	8	-26	60	25	4	0	0
40%	-10	0	2	23	32	20	-6	79	63	4	0	1
50%	4	6	9	29	35	11	-8	48	75	5	1	2
60%	-2	10	17	21	10	9	-4	25	98	3	3	1
70%	6	17	17	3	-13	3	-4	17	126	4	4	6
80%	0	8	24	9	-7	0	-1	9	132	5	3	4
90%	-3	15	-35	-2	-22	-5	0	1	36	-29	-75	-37
Long Term												
Full Simulation Period ^b	-5	6	6	17	21	9	-10	42	64	10	-5	-4
Water Year Types ^c												
Wet (23%)	2	14	12	1	-12	6	-4	42	109	8	-3	0
Above Normal (24%)	-2	7	9	16	12	4	-14	34	53	11	-4	-4
Below Normal (10%)	4	7	10	31	31	17	-16	44	40	1	-11	-10
Dry (16%)	-6	-2	-3	25	32	3	-8	39	52	1	-9	-3
Critical (27%)	-16	1	3	23	49	18	-9	52	49	19	-5	-4

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period

^c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.15.6. San Joaquin River at Vernalis, Monthly EC

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Second Basis of Comparison												
Probability of Exceedance ^a												
10%	711	635	785	776	931	836	592	540	645	648	635	603
20%	681	603	766	750	875	799	537	526	638	648	604	586
30%	655	578	751	726	826	724	461	485	615	645	582	568
40%	623	564	734	713	786	681	398	429	564	636	573	551
50%	590	548	723	689	695	611	341	373	532	624	559	538
60%	569	529	710	677	626	494	309	356	485	614	545	521
70%	541	513	698	645	477	353	289	344	434	603	529	488
80%	520	488	668	574	328	306	260	294	380	581	454	478
90%	477	456	609	391	285	258	205	192	335	498	440	437
Long Term												
Full Simulation Period ^b	595	539	695	646	636	564	383	391	505	597	542	525
Water Year Types ^c												
Wet (23%)	475	442	598	525	490	431	325	353	439	574	514	489
Above Normal (24%)	549	512	686	654	622	543	383	402	534	614	541	532
Below Normal (10%)	604	561	727	692	702	627	353	369	496	590	520	518
Dry (16%)	641	573	705	659	635	533	370	356	473	580	533	500
Critical (27%)	715	621	770	719	753	692	452	442	556	614	579	565

Alternative 5

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	576	638	800	774	941	847	481	525	644	649	639	611
20%	560	608	784	758	901	803	438	511	639	648	609	586
30%	548	588	772	746	855	737	390	467	624	645	580	568
40%	524	579	766	739	802	696	353	410	591	636	573	551
50%	503	565	761	727	697	623	326	367	555	624	558	538
60%	491	552	755	710	635	460	302	349	498	614	544	521
70%	475	538	739	651	477	333	284	331	455	603	524	489
80%	460	509	710	585	329	297	255	293	416	581	455	476
90%	430	481	628	392	286	264	205	190	361	500	433	437
Long Term												
Full Simulation Period ^b	504	554	721	661	649	565	339	383	525	602	543	527
Water Year Types ^c												
Wet (23%)	428	466	633	547	512	425	292	345	478	574	512	489
Above Normal (24%)	481	530	716	674	638	546	347	394	546	614	541	536
Below Normal (10%)	512	583	764	717	720	630	327	377	515	598	531	521
Dry (16%)	537	585	726	670	640	539	329	348	494	589	533	507
Critical (27%)	572	627	784	721	757	694	382	427	567	623	581	566

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly EC (UMHOS/CM)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-135	3	14	-1	10	11	-111	-16	-1	0	4	7
20%	-121	6	18	8	26	3	-99	-15	0	0	5	0
30%	-107	10	21	20	29	13	-72	-18	9	-1	-2	0
40%	-99	15	33	25	16	15	-45	-20	28	0	0	0
50%	-87	17	39	38	1	12	-15	-5	23	1	-1	0
60%	-78	24	45	32	9	-34	-8	-8	13	0	-1	0
70%	-66	25	41	5	0	-20	-5	-12	21	0	-6	0
80%	-60	21	42	11	1	-9	-5	0	37	0	0	-2
90%	-48	25	19	1	1	6	0	-2	26	2	-7	0
Long Term												
Full Simulation Period ^b	-91	16	26	15	13	1	-44	-8	20	5	1	2
Water Year Types ^c												
Wet (23%)	-47	24	35	22	22	-6	-33	-8	39	0	-2	-1
Above Normal (24%)	-68	17	30	20	15	3	-36	-8	12	0	1	4
Below Normal (10%)	-91	22	37	25	18	3	-26	8	19	8	11	3
Dry (16%)	-104	11	21	10	5	6	-41	-8	21	10	0	7
Critical (27%)	-143	6	15	2	4	2	-70	-15	11	9	2	1

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period

^c As defined by the San Joaquin Valley 60-20-20 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1 **B.16. Sacramento River at Mallard Slough Chloride**
2 **Concentration**

3

Table 6E.B.16.1. Sacramento River at Mallard Slough, Monthly Chloride Concentration

No Action Alternative												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,292.5	4,377.7	3,764.3	2,376.9	1,054.1	873.1	1,185.6	1,568.7	2,001.4	2,779.5	3,422.7	3,859.9
20%	3,943.4	3,866.0	3,185.1	2,012.0	596.0	606.6	708.9	1,319.2	1,789.0	2,422.7	3,081.0	3,621.1
30%	3,900.3	3,740.2	2,264.3	1,602.9	300.9	228.7	473.0	1,094.6	1,660.3	2,228.7	2,946.1	3,512.6
40%	3,808.2	3,193.4	1,941.4	890.4	164.1	168.9	268.0	615.5	1,503.1	1,801.5	2,543.1	3,297.9
50%	3,486.5	1,721.7	1,718.4	642.6	82.0	71.9	161.4	441.4	1,191.4	1,584.4	2,305.5	2,954.9
60%	1,745.2	1,626.4	1,515.8	283.8	27.0	29.8	73.6	254.5	1,093.0	1,251.5	2,220.2	1,631.3
70%	854.0	845.9	611.7	45.6	20.6	19.3	39.2	161.8	824.1	1,158.1	2,121.0	890.8
80%	820.0	768.0	196.6	20.8	18.3	17.6	20.2	48.8	484.0	1,052.1	2,001.6	809.6
90%	780.5	722.2	40.8	17.2	16.8	16.8	17.4	17.7	121.2	901.5	1,919.2	787.5
Long Term												
Full Simulation Period ^b	2,564.0	2,295.0	1,749.1	962.9	377.6	279.6	390.3	668.5	1,239.7	1,711.5	2,511.6	2,359.4
Water Year Types^c												
Wet (32%)	1,888.6	1,477.4	566.7	169.3	27.4	33.4	52.6	127.0	528.9	928.7	1,983.6	801.7
Above Normal (16%)	3,098.5	2,363.8	1,549.1	401.8	87.3	58.2	91.1	267.5	1,012.2	1,203.8	2,037.2	1,633.3
Below Normal (13%)	1,919.6	1,837.8	1,847.7	1,172.0	436.7	381.6	467.7	759.6	1,415.1	1,641.1	2,356.3	3,172.4
Dry (24%)	2,783.4	2,701.6	2,477.6	1,537.9	560.5	314.7	493.3	905.0	1,528.1	2,297.7	2,986.8	3,495.0
Critical (15%)	3,673.1	3,733.3	3,223.1	2,140.1	1,091.9	901.1	1,203.8	1,798.4	2,384.5	3,044.6	3,519.7	3,883.2
Alternative 1												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,250.7	4,314.5	3,765.9	3,038.4	1,582.1	1,184.6	1,254.0	1,619.2	2,008.3	2,762.1	3,502.7	3,858.6
20%	3,909.5	3,848.8	3,725.0	2,663.1	889.8	672.9	894.9	1,343.2	1,733.9	2,436.3	3,135.8	3,648.2
30%	3,810.5	3,765.9	3,464.4	2,225.6	562.1	301.0	701.2	1,225.3	1,554.4	2,263.5	3,022.9	3,516.2
40%	3,749.6	3,691.9	3,277.4	1,482.1	252.6	238.4	478.8	845.2	1,312.4	1,778.6	2,660.3	3,332.3
50%	3,631.4	3,584.4	2,841.3	991.3	136.5	110.1	318.6	677.3	1,184.6	1,615.7	2,369.1	3,151.6
60%	3,530.3	3,431.9	2,092.8	439.3	44.9	29.4	165.0	449.0	1,054.1	1,358.6	2,226.2	3,030.1
70%	3,459.6	3,363.6	1,104.9	62.1	20.6	19.4	57.9	305.4	850.2	1,267.7	2,170.8	2,985.5
80%	3,338.6	3,067.7	480.2	23.2	18.5	17.8	21.6	76.5	576.7	1,087.7	2,106.7	2,918.2
90%	2,991.4	1,664.6	106.4	17.3	16.6	17.0	17.2	18.1	132.3	915.0	1,972.8	2,820.6
Long Term												
Full Simulation Period ^b	3,528.9	3,257.1	2,292.5	1,249.8	502.1	341.2	481.9	780.9	1,213.0	1,747.8	2,572.0	3,187.6
Water Year Types^c												
Wet (32%)	3,181.2	2,759.1	923.1	253.4	33.7	36.7	93.2	202.4	520.6	979.9	2,025.4	2,681.5
Above Normal (16%)	3,740.6	3,172.3	2,232.7	622.5	133.6	65.4	173.0	431.3	961.6	1,249.8	2,121.9	2,978.5
Below Normal (13%)	3,399.8	3,040.6	2,599.9	1,756.2	676.2	455.5	618.7	915.8	1,259.8	1,675.1	2,482.8	3,224.3
Dry (24%)	3,676.1	3,632.6	3,163.9	2,015.6	744.8	404.7	613.8	1,009.1	1,515.1	2,302.0	3,037.0	3,536.5
Critical (15%)	3,926.2	4,001.0	3,590.2	2,347.6	1,352.3	1,089.4	1,313.8	1,908.7	2,439.3	3,093.9	3,551.0	3,895.6
Alternative 1 minus No Action Alternative												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-41.8	-63.2	1.6	661.6	528.0	311.4	68.4	50.5	6.9	-17.3	80.0	-1.4
20%	-33.9	-17.2	539.9	651.2	293.8	66.3	186.0	24.1	-55.1	13.6	54.8	27.1
30%	-89.8	25.7	1,200.1	622.7	261.2	72.3	228.2	130.7	-105.9	34.8	76.7	3.6
40%	-58.6	498.5	1,336.0	591.7	88.5	69.6	210.8	229.6	-190.7	-22.9	117.2	34.4
50%	144.9	1,862.7	1,123.0	348.7	54.5	38.2	157.2	235.8	-6.8	31.2	63.7	196.7
60%	1,785.1	1,805.5	577.1	155.5	17.9	-0.4	91.4	194.6	-38.9	107.0	6.1	1,398.8
70%	2,605.6	2,517.6	493.2	16.5	-0.1	0.2	18.8	143.6	26.1	109.6	49.8	2,094.8
80%	2,518.6	2,299.7	283.6	2.4	0.2	0.3	1.4	27.7	92.6	35.6	105.2	2,108.6
90%	2,210.9	942.4	65.6	0.1	-0.1	0.3	-0.2	0.5	11.0	13.6	53.5	2,033.1
Long Term												
Full Simulation Period ^b	965.0	962.2	543.4	286.9	124.5	61.6	91.6	112.4	-26.6	36.3	60.5	828.2
Water Year Types^c												
Wet (32%)	1,292.6	1,281.7	356.4	84.1	6.3	3.3	40.5	75.3	-8.3	51.2	41.8	1,879.8
Above Normal (16%)	642.1	808.5	683.6	220.7	46.4	7.2	81.9	163.8	-50.6	46.0	84.7	1,345.2
Below Normal (13%)	1,480.2	1,202.8	752.3	584.3	239.5	73.9	151.0	156.2	-155.3	34.0	126.5	51.9
Dry (24%)	892.7	930.9	686.2	477.8	184.3	89.9	120.6	104.1	-13.0	4.2	50.1	41.5
Critical (15%)	253.1	267.6	367.0	207.4	260.4	188.3	110.0	110.4	54.8	49.3	31.3	12.4

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.16.2. Sacramento River at Mallard Slough, Monthly Chloride Concentration

No Action Alternative												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,292.5	4,377.7	3,764.3	2,376.9	1,054.1	873.1	1,185.6	1,568.7	2,001.4	2,779.5	3,422.7	3,859.9
20%	3,943.4	3,866.0	3,185.1	2,012.0	596.0	606.6	708.9	1,319.2	1,789.0	2,422.7	3,081.0	3,621.1
30%	3,900.3	3,740.2	2,264.3	1,602.9	300.9	228.7	473.0	1,094.6	1,660.3	2,228.7	2,946.1	3,512.6
40%	3,808.2	3,193.4	1,941.4	890.4	164.1	168.9	268.0	615.5	1,503.1	1,801.5	2,543.1	3,297.9
50%	3,486.5	1,721.7	1,718.4	642.6	82.0	71.9	161.4	441.4	1,191.4	1,584.4	2,305.5	2,954.9
60%	1,745.2	1,626.4	1,515.8	283.8	27.0	29.8	73.6	254.5	1,093.0	1,251.5	2,220.2	1,631.3
70%	854.0	845.9	611.7	45.6	20.6	19.3	39.2	161.8	824.1	1,158.1	2,121.0	890.8
80%	820.0	768.0	196.6	20.8	18.3	17.6	20.2	48.8	484.0	1,052.1	2,001.6	809.6
90%	780.5	722.2	40.8	17.2	16.8	16.8	17.4	17.7	121.2	901.5	1,919.2	787.5
Long Term												
Full Simulation Period ^b	2,564.0	2,295.0	1,749.1	962.9	377.6	279.6	390.3	668.5	1,239.7	1,711.5	2,511.6	2,359.4
Water Year Types^c												
Wet (32%)	1,888.6	1,477.4	566.7	169.3	27.4	33.4	52.6	127.0	528.9	928.7	1,983.6	801.7
Above Normal (16%)	3,098.5	2,363.8	1,549.1	401.8	87.3	58.2	91.1	267.5	1,012.2	1,203.8	2,037.2	1,633.3
Below Normal (13%)	1,919.6	1,837.8	1,847.7	1,172.0	436.7	381.6	467.7	759.6	1,415.1	1,641.1	2,356.3	3,172.4
Dry (24%)	2,783.4	2,701.6	2,477.6	1,537.9	560.5	314.7	493.3	905.0	1,528.1	2,297.7	2,986.8	3,495.0
Critical (15%)	3,673.1	3,733.3	3,223.1	2,140.1	1,091.9	901.1	1,203.8	1,798.4	2,384.5	3,044.6	3,519.7	3,883.2
Alternative 3												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,241.2	4,380.5	3,774.2	2,674.8	1,113.8	871.9	1,160.2	1,661.6	1,999.3	2,747.5	3,459.4	3,894.2
20%	3,942.9	3,891.3	3,669.5	2,291.5	598.5	599.4	848.3	1,354.1	1,809.5	2,425.3	3,114.3	3,630.4
30%	3,867.4	3,777.0	3,468.7	1,964.3	323.1	232.3	578.0	1,208.5	1,665.0	2,269.3	2,932.5	3,524.6
40%	3,744.8	3,705.3	3,158.9	999.4	205.4	176.6	439.0	911.8	1,542.5	1,746.6	2,532.3	3,242.2
50%	3,609.3	3,626.2	2,821.5	692.6	92.5	85.8	296.3	742.2	1,316.8	1,593.4	2,270.5	3,085.0
60%	3,497.6	3,451.7	2,109.0	281.2	23.6	30.6	156.3	502.5	1,135.9	1,282.2	2,211.4	2,991.8
70%	3,448.6	3,357.6	814.4	43.8	20.2	19.0	69.2	307.7	916.2	1,182.9	2,097.0	2,920.9
80%	3,343.9	3,048.0	458.6	20.7	18.2	17.7	20.7	105.4	632.0	1,104.6	2,039.3	2,890.5
90%	3,058.9	1,584.8	105.3	17.1	16.7	16.9	17.0	18.4	169.3	924.6	1,892.4	2,822.4
Long Term												
Full Simulation Period ^b	3,547.9	3,288.1	2,246.6	1,070.7	384.1	280.8	450.5	792.7	1,294.1	1,727.0	2,522.0	3,163.0
Water Year Types^c												
Wet (32%)	3,165.3	2,778.1	880.0	195.1	28.7	38.5	93.3	227.1	597.8	957.8	1,971.7	2,666.5
Above Normal (16%)	3,808.5	3,200.3	2,130.3	461.7	80.1	57.0	160.9	454.5	1,075.0	1,228.0	2,069.6	2,957.6
Below Normal (13%)	3,450.9	3,103.8	2,605.7	1,364.5	447.1	379.0	572.2	937.3	1,483.4	1,641.2	2,342.5	3,106.0
Dry (24%)	3,668.3	3,656.4	3,140.2	1,718.9	558.2	314.6	560.5	1,024.8	1,565.7	2,280.4	3,006.5	3,527.8
Critical (15%)	3,982.6	4,043.8	3,514.9	2,278.3	1,135.5	901.8	1,243.4	1,865.2	2,413.9	3,090.7	3,561.1	3,905.5
Alternative 3 minus No Action Alternative												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-51.2	2.8	9.9	298.0	59.7	-1.2	-25.4	92.8	-2.0	-32.0	36.7	34.3
20%	-0.5	25.3	484.4	279.5	2.5	-7.2	139.3	34.9	20.5	2.6	33.3	9.3
30%	-32.9	36.8	1,204.4	361.4	22.1	3.6	104.9	113.9	4.7	40.6	-13.6	12.0
40%	-63.4	511.9	1,217.5	109.0	41.4	7.7	171.0	296.2	39.4	-54.9	-10.7	-55.7
50%	122.8	1,904.5	1,103.2	50.0	10.6	13.9	135.0	300.8	125.4	8.9	-35.0	130.1
60%	1,752.4	1,825.4	593.2	-2.6	-3.4	0.8	82.6	248.1	42.8	30.6	-8.8	1,360.5
70%	2,594.5	2,511.7	202.7	-1.8	-0.5	-0.3	30.0	145.9	92.1	24.8	-24.0	2,030.2
80%	2,523.8	2,280.1	262.0	0.0	0.0	0.2	0.5	56.7	147.9	52.5	37.7	2,080.9
90%	2,278.4	862.6	64.6	0.0	-0.1	0.1	-0.4	0.8	48.0	23.1	-26.8	2,035.0
Long Term												
Full Simulation Period ^b	983.9	993.2	497.5	107.9	6.5	1.1	60.2	124.2	54.4	15.6	10.4	803.6
Water Year Types^c												
Wet (32%)	1,276.7	1,300.7	313.4	25.8	1.3	5.1	40.7	100.0	68.9	29.0	-11.9	1,864.8
Above Normal (16%)	710.0	836.4	581.2	59.8	-7.2	-1.2	69.7	187.0	62.8	24.2	32.4	1,324.4
Below Normal (13%)	1,531.4	1,266.0	758.1	192.6	10.5	-2.6	104.4	177.7	68.3	0.1	-13.8	-66.4
Dry (24%)	884.9	954.7	662.6	181.0	-2.3	-0.1	67.3	119.8	37.7	-17.3	19.6	32.8
Critical (15%)	309.5	310.4	291.8	138.2	43.6	0.7	39.6	66.8	29.4	46.1	41.4	22.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.16.3. Sacramento River at Mallard Slough, Monthly Chloride Concentration

No Action Alternative												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,292.5	4,377.7	3,764.3	2,376.9	1,054.1	873.1	1,185.6	1,568.7	2,001.4	2,779.5	3,422.7	3,859.9
20%	3,943.4	3,866.0	3,185.1	2,012.0	596.0	606.6	708.9	1,319.2	1,789.0	2,422.7	3,081.0	3,621.1
30%	3,900.3	3,740.2	2,264.3	1,602.9	300.9	228.7	473.0	1,094.6	1,660.3	2,228.7	2,946.1	3,512.6
40%	3,808.2	3,193.4	1,941.4	890.4	164.1	168.9	268.0	615.5	1,503.1	1,801.5	2,543.1	3,297.9
50%	3,486.5	1,721.7	1,718.4	642.6	82.0	71.9	161.4	441.4	1,191.4	1,584.4	2,305.5	2,954.9
60%	1,745.2	1,626.4	1,515.8	283.8	27.0	29.8	73.6	254.5	1,093.0	1,251.5	2,220.2	1,631.3
70%	854.0	845.9	611.7	45.6	20.6	19.3	39.2	161.8	824.1	1,158.1	2,121.0	890.8
80%	820.0	768.0	196.6	20.8	18.3	17.6	20.2	48.8	484.0	1,052.1	2,001.6	809.6
90%	780.5	722.2	40.8	17.2	16.8	16.8	17.4	17.7	121.2	901.5	1,919.2	787.5
Long Term												
Full Simulation Period ^b	2,564.0	2,295.0	1,749.1	962.9	377.6	279.6	390.3	668.5	1,239.7	1,711.5	2,511.6	2,359.4
Water Year Types^c												
Wet (32%)	1,888.6	1,477.4	566.7	169.3	27.4	33.4	52.6	127.0	528.9	928.7	1,983.6	801.7
Above Normal (16%)	3,098.5	2,363.8	1,549.1	401.8	87.3	58.2	91.1	267.5	1,012.2	1,203.8	2,037.2	1,633.3
Below Normal (13%)	1,919.6	1,837.8	1,847.7	1,172.0	436.7	381.6	467.7	759.6	1,415.1	1,641.1	2,356.3	3,172.4
Dry (24%)	2,783.4	2,701.6	2,477.6	1,537.9	560.5	314.7	493.3	905.0	1,528.1	2,297.7	2,986.8	3,495.0
Critical (15%)	3,673.1	3,733.3	3,223.1	2,140.1	1,091.9	901.1	1,203.8	1,798.4	2,384.5	3,044.6	3,519.7	3,883.2
Alternative 5												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,293.7	4,345.7	3,764.7	2,374.0	1,056.9	874.4	1,014.1	1,313.3	1,961.5	2,775.6	3,404.4	3,826.0
20%	3,966.6	3,872.0	3,135.0	2,018.5	597.5	606.8	659.9	1,137.6	1,699.1	2,376.0	3,096.7	3,606.0
30%	3,896.2	3,740.9	2,268.7	1,603.0	300.1	233.1	433.7	942.9	1,640.7	2,211.4	2,939.6	3,527.3
40%	3,783.0	3,184.6	1,940.6	890.2	163.3	168.9	243.9	579.5	1,435.9	1,793.9	2,534.8	3,286.5
50%	3,442.7	1,713.0	1,722.2	644.3	81.9	75.1	162.6	414.0	1,198.2	1,586.2	2,310.1	2,920.1
60%	1,745.8	1,607.6	1,515.1	283.0	26.9	29.7	75.3	265.3	1,092.5	1,257.2	2,206.0	1,645.4
70%	853.7	845.8	602.4	44.9	20.7	19.3	39.2	150.4	815.7	1,158.4	2,108.8	889.6
80%	822.4	768.2	198.5	20.6	18.3	17.6	20.3	44.2	479.2	1,056.3	1,987.2	811.7
90%	779.1	722.7	44.2	17.2	16.8	16.8	17.4	17.7	121.5	905.1	1,921.1	790.3
Long Term												
Full Simulation Period ^b	2,561.5	2,286.6	1,749.0	970.3	384.0	280.7	351.0	596.7	1,199.6	1,695.3	2,497.3	2,355.7
Water Year Types^c												
Wet (32%)	1,888.0	1,483.3	567.3	169.1	27.3	33.3	51.7	118.7	525.6	917.9	1,966.9	801.3
Above Normal (16%)	3,093.7	2,312.9	1,531.9	401.2	87.3	58.3	90.5	258.4	1,006.5	1,203.4	2,036.7	1,638.7
Below Normal (13%)	1,922.9	1,839.4	1,849.4	1,173.8	436.3	381.4	421.2	685.0	1,391.6	1,634.0	2,343.2	3,151.1
Dry (24%)	2,780.3	2,695.5	2,486.2	1,546.8	563.2	315.7	422.6	795.8	1,478.1	2,284.1	2,974.6	3,493.1
Critical (15%)	3,664.9	3,727.3	3,223.7	2,175.6	1,131.4	906.8	1,097.6	1,586.2	2,229.1	2,987.1	3,491.1	3,875.3
Alternative 5 minus No Action Alternative												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1.2	-32.0	0.3	-2.8	2.8	1.2	-171.5	-255.5	-39.9	-3.9	-18.4	-34.0
20%	23.2	6.0	-50.1	6.5	1.5	0.1	-49.1	-181.6	-89.9	-46.7	15.7	-15.2
30%	-4.1	0.7	4.4	0.0	-0.8	4.4	-39.3	-151.7	-19.5	-17.2	-6.5	14.7
40%	-25.2	-8.7	-0.8	-0.2	-0.8	0.1	-24.1	-36.0	-67.2	-7.6	-8.2	-11.4
50%	-43.8	-8.8	3.9	1.8	-0.1	3.2	1.2	-27.5	6.8	1.8	4.6	-34.8
60%	0.5	-18.8	-0.6	-0.8	-0.2	-0.1	1.6	10.8	-0.5	5.7	-14.2	14.1
70%	-0.3	-0.1	-9.3	-0.8	0.0	0.0	0.0	-11.4	-8.4	0.3	-12.2	-1.2
80%	2.4	0.3	1.9	-0.1	0.0	0.0	0.2	-4.5	-4.8	4.2	-14.4	2.1
90%	-1.4	0.5	3.5	0.0	0.0	0.0	0.0	0.0	0.2	3.7	1.8	2.9
Long Term												
Full Simulation Period ^b	-2.5	-8.3	-0.1	7.4	6.4	1.0	-39.4	-71.8	-40.0	-16.2	-14.3	-3.7
Water Year Types^c												
Wet (32%)	-0.6	6.0	0.7	-0.2	0.0	-0.1	-0.9	-8.4	-3.3	-10.8	-16.7	-0.4
Above Normal (16%)	-4.8	-51.0	-17.2	-0.7	0.0	0.1	-0.6	-9.0	-5.7	-0.4	-0.5	5.4
Below Normal (13%)	3.4	1.6	1.7	1.9	-0.4	-0.2	-46.5	-74.6	-23.5	-7.1	-13.1	-21.3
Dry (24%)	-3.1	-6.1	8.6	8.9	2.7	1.0	-70.7	-109.3	-50.0	-13.6	-12.2	-1.9
Critical (15%)	-8.2	-6.1	0.5	35.4	39.5	5.8	-106.2	-212.2	-155.4	-57.5	-28.5	-7.9

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.16.4. Sacramento River at Mallard Slough, Monthly Chloride Concentration

Second Basis of Comparison												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,250.7	4,314.5	3,765.9	3,038.4	1,582.1	1,184.6	1,254.0	1,619.2	2,008.3	2,762.1	3,502.7	3,858.6
20%	3,909.5	3,848.8	3,725.0	2,663.1	889.8	672.9	894.9	1,343.2	1,733.9	2,436.3	3,135.8	3,648.2
30%	3,810.5	3,765.9	3,464.4	2,225.6	562.1	301.0	701.2	1,225.3	1,554.4	2,263.5	3,022.9	3,516.2
40%	3,749.6	3,691.9	3,277.4	1,482.1	252.6	238.4	478.8	845.2	1,312.4	1,778.6	2,660.3	3,332.3
50%	3,631.4	3,584.4	2,841.3	991.3	136.5	110.1	318.6	677.3	1,184.6	1,615.7	2,369.1	3,151.6
60%	3,530.3	3,431.9	2,092.8	439.3	44.9	29.4	165.0	449.0	1,054.1	1,358.6	2,226.2	3,030.1
70%	3,459.6	3,363.6	1,104.9	62.1	20.6	19.4	57.9	305.4	850.2	1,267.7	2,170.8	2,985.5
80%	3,338.6	3,067.7	480.2	23.2	18.5	17.8	21.6	76.5	576.7	1,087.7	2,106.7	2,918.2
90%	2,991.4	1,664.6	106.4	17.3	16.6	17.0	17.2	18.1	132.3	915.0	1,972.8	2,820.6
Long Term												
Full Simulation Period ^b	3,528.9	3,257.1	2,292.5	1,249.8	502.1	341.2	481.9	780.9	1,213.0	1,747.8	2,572.0	3,187.6
Water Year Types^c												
Wet (32%)	3,181.2	2,759.1	923.1	253.4	33.7	36.7	93.2	202.4	520.6	979.9	2,025.4	2,681.5
Above Normal (16%)	3,740.6	3,172.3	2,232.7	622.5	133.6	65.4	173.0	431.3	961.6	1,249.8	2,121.9	2,978.5
Below Normal (13%)	3,399.8	3,040.6	2,599.9	1,756.2	676.2	455.5	618.7	915.8	1,259.8	1,675.1	2,482.8	3,224.3
Dry (24%)	3,676.1	3,632.6	3,163.9	2,015.6	744.8	404.7	613.8	1,009.1	1,515.1	2,302.0	3,037.0	3,536.5
Critical (15%)	3,926.2	4,001.0	3,590.2	2,347.6	1,352.3	1,089.4	1,313.8	1,908.7	2,439.3	3,093.9	3,551.0	3,895.6
No Action Alternative												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4,292.5	4,377.7	3,764.3	2,376.9	1,054.1	873.1	1,185.6	1,568.7	2,001.4	2,779.5	3,422.7	3,859.9
20%	3,943.4	3,866.0	3,185.1	2,012.0	596.0	606.6	708.9	1,319.2	1,789.0	2,422.7	3,081.0	3,621.1
30%	3,900.3	3,740.2	2,264.3	1,602.9	300.9	228.7	473.0	1,094.6	1,660.3	2,228.7	2,946.1	3,512.6
40%	3,808.2	3,193.4	1,941.4	890.4	164.1	168.9	268.0	615.5	1,503.1	1,801.5	2,543.1	3,297.9
50%	3,486.5	1,721.7	1,718.4	642.6	82.0	71.9	161.4	441.4	1,191.4	1,584.4	2,305.5	2,954.9
60%	1,745.2	1,626.4	1,515.8	283.8	27.0	29.8	73.6	254.5	1,093.0	1,251.5	2,220.2	1,631.3
70%	854.0	845.9	611.7	45.6	20.6	19.3	39.2	161.8	824.1	1,158.1	2,121.0	890.8
80%	820.0	768.0	196.6	20.8	18.3	17.6	20.2	48.8	484.0	1,052.1	2,001.6	809.6
90%	780.5	722.2	40.8	17.2	16.8	16.8	17.4	17.7	121.2	901.5	1,919.2	787.5
Long Term												
Full Simulation Period ^b	2,564.0	2,295.0	1,749.1	962.9	377.6	279.6	390.3	668.5	1,239.7	1,711.5	2,511.6	2,359.4
Water Year Types^c												
Wet (32%)	1,888.6	1,477.4	566.7	169.3	27.4	33.4	52.6	127.0	528.9	928.7	1,983.6	801.7
Above Normal (16%)	3,098.5	2,363.8	1,549.1	401.8	87.3	58.2	91.1	267.5	1,012.2	1,203.8	2,037.2	1,633.3
Below Normal (13%)	1,919.6	1,837.8	1,847.7	1,172.0	436.7	381.6	467.7	759.6	1,415.1	1,641.1	2,356.3	3,172.4
Dry (24%)	2,783.4	2,701.6	2,477.6	1,537.9	560.5	314.7	493.3	905.0	1,528.1	2,297.7	2,986.8	3,495.0
Critical (15%)	3,673.1	3,733.3	3,223.1	2,140.1	1,091.9	901.1	1,203.8	1,798.4	2,384.5	3,044.6	3,519.7	3,883.2
No Action Alternative minus Second Basis of Comparison												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	41.8	63.2	-1.6	-661.6	-528.0	-311.4	-68.4	-50.5	-6.9	17.3	-80.0	1.4
20%	33.9	17.2	-539.9	-651.2	-293.8	-66.3	-186.0	-24.1	55.1	-13.6	-54.8	-27.1
30%	89.8	-25.7	-1,200.1	-622.7	-261.2	-72.3	-228.2	-130.7	105.9	-34.8	-76.7	-3.6
40%	58.6	-498.5	-1,336.0	-591.7	-88.5	-69.6	-210.8	-229.6	190.7	22.9	-117.2	-34.4
50%	-144.9	-1,862.7	-1,123.0	-348.7	-54.5	-38.2	-157.2	-235.8	6.8	-31.2	-63.7	-196.7
60%	-1,785.1	-1,805.5	-577.1	-155.5	-17.9	0.4	-91.4	-194.6	38.9	-107.0	-6.1	-1,398.8
70%	-2,605.6	-2,517.6	-493.2	-16.5	0.1	-0.2	-18.8	-143.6	-26.1	-109.6	-49.8	-2,094.8
80%	-2,518.6	-2,299.7	-283.6	-2.4	-0.2	-0.3	-1.4	-27.7	-92.6	-35.6	-105.2	-2,108.6
90%	-2,210.9	-942.4	-65.6	-0.1	0.1	-0.3	0.2	-0.5	-11.0	-13.6	-53.5	-2,033.1
Long Term												
Full Simulation Period ^b	-965.0	-962.2	-543.4	-286.9	-124.5	-61.6	-91.6	-112.4	26.6	-36.3	-60.5	-828.2
Water Year Types^c												
Wet (32%)	-1,292.6	-1,281.7	-356.4	-84.1	-6.3	-3.3	-40.5	-75.3	8.3	-51.2	-41.8	-1,879.8
Above Normal (16%)	-642.1	-808.5	-683.6	-220.7	-46.4	-7.2	-81.9	-163.8	50.6	-46.0	-84.7	-1,345.2
Below Normal (13%)	-1,480.2	-1,202.8	-752.3	-584.3	-239.5	-73.9	-151.0	-156.2	155.3	-34.0	-126.5	-51.9
Dry (24%)	-892.7	-930.9	-686.2	-477.8	-184.3	-89.9	-120.6	-104.1	13.0	-4.2	-50.1	-41.5
Critical (15%)	-253.1	-267.6	-367.0	-207.4	-260.4	-188.3	-110.0	-110.4	-54.8	-49.3	-31.3	-12.4

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.16.5. Sacramento River at Mallard Slough, Monthly Chloride Concentration

Second Basis of Comparison		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a													
10%		4,250.7	4,314.5	3,765.9	3,038.4	1,582.1	1,184.6	1,254.0	1,619.2	2,008.3	2,762.1	3,502.7	3,858.6
20%		3,909.5	3,848.8	3,725.0	2,663.1	889.8	672.9	894.9	1,343.2	1,733.9	2,436.3	3,135.8	3,648.2
30%		3,810.5	3,765.9	3,464.4	2,225.6	562.1	301.0	701.2	1,225.3	1,554.4	2,263.5	3,022.9	3,516.2
40%		3,749.6	3,691.9	3,277.4	1,482.1	252.6	238.4	478.8	845.2	1,312.4	1,778.6	2,660.3	3,332.3
50%		3,631.4	3,584.4	2,841.3	991.3	136.5	110.1	318.6	677.3	1,184.6	1,615.7	2,369.1	3,151.6
60%		3,530.3	3,431.9	2,092.8	439.3	44.9	29.4	165.0	449.0	1,054.1	1,358.6	2,226.2	3,030.1
70%		3,459.6	3,363.6	1,104.9	62.1	20.6	19.4	57.9	305.4	850.2	1,267.7	2,170.8	2,985.5
80%		3,338.6	3,067.7	480.2	23.2	18.5	17.8	21.6	76.5	576.7	1,087.7	2,106.7	2,918.2
90%		2,991.4	1,664.6	106.4	17.3	16.6	17.0	17.2	18.1	132.3	915.0	1,972.8	2,820.6
Long Term													
Full Simulation Period ^b		3,528.9	3,257.1	2,292.5	1,249.8	502.1	341.2	481.9	780.9	1,213.0	1,747.8	2,572.0	3,187.6
Water Year Types^c													
Wet (32%)		3,181.2	2,759.1	923.1	253.4	33.7	36.7	93.2	202.4	520.6	979.9	2,025.4	2,681.5
Above Normal (16%)		3,740.6	3,172.3	2,232.7	622.5	133.6	65.4	173.0	431.3	961.6	1,249.8	2,121.9	2,978.5
Below Normal (13%)		3,399.8	3,040.6	2,599.9	1,756.2	676.2	455.5	618.7	915.8	1,259.8	1,675.1	2,482.8	3,224.3
Dry (24%)		3,676.1	3,632.6	3,163.9	2,015.6	744.8	404.7	613.8	1,009.1	1,515.1	2,302.0	3,037.0	3,536.5
Critical (15%)		3,926.2	4,001.0	3,590.2	2,347.6	1,352.3	1,089.4	1,313.8	1,908.7	2,439.3	3,093.9	3,551.0	3,895.6

Alternative 3

Alternative 3		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a													
10%		4,241.2	4,380.5	3,774.2	2,674.8	1,113.8	871.9	1,160.2	1,661.6	1,999.3	2,747.5	3,459.4	3,894.2
20%		3,942.9	3,891.3	3,669.5	2,291.5	598.5	599.4	848.3	1,354.1	1,809.5	2,425.3	3,114.3	3,630.4
30%		3,867.4	3,777.0	3,468.7	1,964.3	323.1	232.3	578.0	1,208.5	1,665.0	2,269.3	2,932.5	3,524.6
40%		3,744.8	3,705.3	3,158.9	999.4	205.4	176.6	439.0	911.8	1,542.5	1,746.6	2,532.3	3,242.2
50%		3,609.3	3,626.2	2,821.5	692.6	92.5	85.8	296.3	742.2	1,316.8	1,593.4	2,270.5	3,085.0
60%		3,497.6	3,451.7	2,109.0	281.2	23.6	30.6	156.3	502.5	1,135.9	1,282.2	2,211.4	2,991.8
70%		3,448.6	3,357.6	814.4	43.8	20.2	19.0	69.2	307.7	916.2	1,182.9	2,097.0	2,920.9
80%		3,343.9	3,048.0	458.6	20.7	18.2	17.7	20.7	105.4	632.0	1,104.6	2,039.3	2,890.5
90%		3,058.9	1,584.8	105.3	17.1	16.7	16.9	17.0	18.4	169.3	924.6	1,892.4	2,822.4
Long Term													
Full Simulation Period ^b		3,547.9	3,288.1	2,246.6	1,070.7	384.1	280.8	450.5	792.7	1,294.1	1,727.0	2,522.0	3,163.0
Water Year Types^c													
Wet (32%)		3,165.3	2,778.1	880.0	195.1	28.7	38.5	93.3	227.1	597.8	957.8	1,971.7	2,666.5
Above Normal (16%)		3,808.5	3,200.3	2,130.3	461.7	80.1	57.0	160.9	454.5	1,075.0	1,228.0	2,069.6	2,957.6
Below Normal (13%)		3,450.9	3,103.8	2,605.7	1,364.5	447.1	379.0	572.2	937.3	1,483.4	1,641.2	2,342.5	3,106.0
Dry (24%)		3,668.3	3,656.4	3,140.2	1,718.9	558.2	314.6	560.5	1,024.8	1,565.7	2,280.4	3,006.5	3,527.8
Critical (15%)		3,982.6	4,043.8	3,514.9	2,278.3	1,135.5	901.8	1,243.4	1,865.2	2,413.9	3,090.7	3,561.1	3,905.5

Alternative 3 minus Second Basis of Comparison

Alternative 3 minus Second Basis of Comparison		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a													
10%		-9.5	66.0	8.3	-363.6	-468.2	-312.7	-93.8	42.4	-8.9	-14.6	-43.3	35.7
20%		33.4	42.5	-55.6	-371.7	-291.3	-73.5	-46.7	10.9	75.6	-11.0	-21.5	-17.8
30%		56.9	11.1	4.4	-261.3	-239.0	-68.7	-123.3	-16.9	110.6	5.8	-90.4	8.4
40%		-4.8	13.4	-118.5	-482.7	-47.2	-61.8	-39.8	66.6	230.1	-32.0	-127.9	-90.1
50%		-22.1	41.8	-19.8	-298.7	-43.9	-24.3	-22.3	65.0	132.2	-22.3	-98.7	-66.6
60%		-32.7	19.9	16.1	-158.1	-21.3	1.2	-8.8	53.5	81.8	-76.4	-14.9	-38.3
70%		-11.0	-5.9	-290.5	-18.3	-0.4	-0.4	11.2	2.3	66.0	-84.8	-73.8	-64.6
80%		5.2	-19.7	-21.6	-2.4	-0.2	-0.1	-0.9	29.0	55.3	16.9	-67.4	-27.7
90%		67.5	-79.8	-1.0	-0.1	0.1	-0.2	-0.2	0.3	37.0	9.6	-80.4	1.8
Long Term													
Full Simulation Period ^b		18.9	31.0	-45.9	-179.1	-118.0	-60.5	-31.4	11.8	81.1	-20.7	-50.1	-24.6
Water Year Types^c													
Wet (32%)		-15.9	19.0	-43.0	-58.3	-5.0	1.8	0.2	24.7	77.2	-22.2	-53.6	-15.1
Above Normal (16%)		67.9	27.9	-102.4	-160.9	-53.6	-8.4	-12.1	23.2	113.4	-21.8	-52.3	-20.8
Below Normal (13%)		51.1	63.2	5.8	-391.7	-229.0	-76.5	-46.5	21.5	223.6	-33.9	-140.3	-118.3
Dry (24%)		-7.8	23.8	-23.6	-296.8	-186.6	-90.1	-53.3	15.7	50.7	-21.5	-30.5	-8.6
Critical (15%)		56.4	42.8	-75.3	-69.2	-216.8	-187.6	-70.4	-43.5	-25.4	-3.2	10.1	9.9

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.16.6. Sacramento River at Mallard Slough, Monthly Chloride Concentration

Second Basis of Comparison		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a													
10%		4,250.7	4,314.5	3,765.9	3,038.4	1,582.1	1,184.6	1,254.0	1,619.2	2,008.3	2,762.1	3,502.7	3,858.6
20%		3,909.5	3,848.8	3,725.0	2,663.1	889.8	672.9	894.9	1,343.2	1,733.9	2,436.3	3,135.8	3,648.2
30%		3,810.5	3,765.9	3,464.4	2,225.6	562.1	301.0	701.2	1,225.3	1,554.4	2,263.5	3,022.9	3,516.2
40%		3,749.6	3,691.9	3,277.4	1,482.1	252.6	238.4	478.8	845.2	1,312.4	1,778.6	2,660.3	3,332.3
50%		3,631.4	3,584.4	2,841.3	991.3	136.5	110.1	318.6	677.3	1,184.6	1,615.7	2,369.1	3,151.6
60%		3,530.3	3,431.9	2,092.8	439.3	44.9	29.4	165.0	449.0	1,054.1	1,358.6	2,226.2	3,030.1
70%		3,459.6	3,363.6	1,104.9	62.1	20.6	19.4	57.9	305.4	850.2	1,267.7	2,170.8	2,985.5
80%		3,338.6	3,067.7	480.2	23.2	18.5	17.8	21.6	76.5	576.7	1,087.7	2,106.7	2,918.2
90%		2,991.4	1,664.6	106.4	17.3	16.6	17.0	17.2	18.1	132.3	915.0	1,972.8	2,820.6
Long Term													
Full Simulation Period ^b		3,528.9	3,257.1	2,292.5	1,249.8	502.1	341.2	481.9	780.9	1,213.0	1,747.8	2,572.0	3,187.6
Water Year Types^c													
Wet (32%)		3,181.2	2,759.1	923.1	253.4	33.7	36.7	93.2	202.4	520.6	979.9	2,025.4	2,681.5
Above Normal (16%)		3,740.6	3,172.3	2,232.7	622.5	133.6	65.4	173.0	431.3	961.6	1,249.8	2,121.9	2,978.5
Below Normal (13%)		3,399.8	3,040.6	2,599.9	1,756.2	676.2	455.5	618.7	915.8	1,259.8	1,675.1	2,482.8	3,224.3
Dry (24%)		3,676.1	3,632.6	3,163.9	2,015.6	744.8	404.7	613.8	1,009.1	1,515.1	2,302.0	3,037.0	3,536.5
Critical (15%)		3,926.2	4,001.0	3,590.2	2,347.6	1,352.3	1,089.4	1,313.8	1,908.7	2,439.3	3,093.9	3,551.0	3,895.6

Alternative 5

Alternative 5		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a													
10%		4,293.7	4,345.7	3,764.7	2,374.0	1,056.9	874.4	1,014.1	1,313.3	1,961.5	2,775.6	3,404.4	3,826.0
20%		3,966.6	3,872.0	3,135.0	2,018.5	597.5	606.8	659.9	1,137.6	1,699.1	2,376.0	3,096.7	3,606.0
30%		3,896.2	3,740.9	2,268.7	1,603.0	300.1	233.1	433.7	942.9	1,640.7	2,211.4	2,939.6	3,527.3
40%		3,783.0	3,184.6	1,940.6	890.2	163.3	168.9	243.9	579.5	1,435.9	1,793.9	2,534.8	3,286.5
50%		3,442.7	1,713.0	1,722.2	644.3	81.9	75.1	162.6	414.0	1,198.2	1,586.2	2,310.1	2,920.1
60%		1,745.8	1,607.6	1,515.1	283.0	26.9	29.7	75.3	265.3	1,092.5	1,257.2	2,206.0	1,645.4
70%		853.7	845.8	602.4	44.9	20.7	19.3	39.2	150.4	815.7	1,158.4	2,108.8	889.6
80%		822.4	768.2	198.5	20.6	18.3	17.6	20.3	44.2	479.2	1,056.3	1,987.2	811.7
90%		779.1	722.7	44.2	17.2	16.8	16.8	17.4	17.7	121.5	905.1	1,921.1	790.3
Long Term													
Full Simulation Period ^b		2,561.5	2,286.6	1,749.0	970.3	384.0	280.7	351.0	596.7	1,199.6	1,695.3	2,497.3	2,355.7
Water Year Types^c													
Wet (32%)		1,888.0	1,483.3	567.3	169.1	27.3	33.3	51.7	118.7	525.6	917.9	1,966.9	801.3
Above Normal (16%)		3,093.7	2,312.9	1,531.9	401.2	87.3	58.3	90.5	258.4	1,006.5	1,203.4	2,036.7	1,638.7
Below Normal (13%)		1,922.9	1,839.4	1,849.4	1,173.8	436.3	381.4	421.2	685.0	1,391.6	1,634.0	2,343.2	3,151.1
Dry (24%)		2,780.3	2,695.5	2,486.2	1,546.8	563.2	315.7	422.6	795.8	1,478.1	2,284.1	2,974.6	3,493.1
Critical (15%)		3,664.9	3,727.3	3,223.7	2,175.6	1,131.4	906.8	1,097.6	1,586.2	2,229.1	2,987.1	3,491.1	3,875.3

Alternative 5 minus Second Basis of Comparison

Alternative 5 minus Second Basis of Comparison		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a													
10%		43.0	31.2	-1.3	-664.4	-525.1	-310.2	-239.9	-305.9	-46.8	13.4	-98.4	-32.6
20%		57.1	23.2	-590.0	-644.7	-292.3	-66.1	-235.1	-205.6	-34.8	-60.3	-39.1	-42.2
30%		85.7	-25.0	-1,195.6	-622.7	-261.9	-67.9	-267.5	-282.5	86.3	-52.1	-83.3	11.1
40%		33.4	-507.2	-1,336.7	-591.9	-89.3	-69.5	-234.9	-265.6	123.5	15.3	-125.4	-45.9
50%		-188.7	-1,871.4	-1,119.1	-347.0	-54.6	-35.0	-156.0	-263.3	13.6	-29.5	-59.1	-231.5
60%		-1,784.5	-1,824.3	-577.7	-156.3	-18.0	0.3	-89.8	-183.7	38.4	-101.3	-20.3	-1,384.7
70%		-2,605.9	-2,517.7	-502.5	-17.2	0.1	-0.2	-18.7	-155.0	-34.5	-109.3	-62.0	-2,095.9
80%		-2,516.2	-2,299.5	-281.7	-2.5	-0.2	-0.2	-1.2	-32.3	-97.5	-31.5	-119.5	-2,106.6
90%		-2,212.3	-941.9	-62.1	-0.1	0.2	-0.2	0.2	-0.5	-10.8	-9.9	-51.7	-2,030.3
Long Term													
Full Simulation Period ^b		-967.4	-970.5	-543.5	-279.5	-118.1	-60.6	-131.0	-184.2	-13.4	-52.5	-74.7	-831.9
Water Year Types^c													
Wet (32%)		-1,293.2	-1,275.7	-355.7	-84.3	-6.3	-3.4	-41.4	-83.7	5.0	-62.0	-58.5	-1,880.3
Above Normal (16%)		-646.9	-859.5	-700.8	-221.4	-46.3	-7.1	-82.5	-172.9	44.8	-46.4	-85.2	-1,339.8
Below Normal (13%)		-1,476.9	-1,201.2	-750.5	-582.4	-239.9	-74.1	-197.5	-230.8	131.8	-41.1	-139.7	-73.2
Dry (24%)		-895.8	-937.1	-677.6	-468.9	-181.6	-89.0	-191.2	-213.4	-37.0	-17.8	-62.3	-43.3
Critical (15%)		-261.3	-273.7	-366.5	-172.0	-220.9	-182.5	-216.2	-322.5	-210.2	-106.8	-59.9	-20.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1
2

B.17. Jones Pumping Plant Chloride Concentration

Table 6E.B.17.1. Jones Pumping Plant, Monthly Chloride Concentration

No Action Alternative		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		159.1	179.5	188.5	178.4	182.6	174.1	125.8	110.0	87.9	76.0	114.1	136.6
20%		150.0	146.0	168.2	167.4	153.1	141.7	104.6	104.8	74.4	64.9	97.4	128.6
30%		143.7	131.4	153.7	150.5	146.1	125.6	85.6	91.9	66.5	60.0	88.3	117.6
40%		133.5	123.8	135.4	140.1	136.2	114.2	74.8	77.9	63.1	57.1	73.1	109.5
50%		123.3	105.3	101.6	132.1	122.2	101.1	55.7	63.2	61.3	52.8	67.2	102.5
60%		62.2	65.7	90.8	122.5	104.1	72.2	44.2	57.3	59.3	49.0	56.5	95.6
70%		58.4	54.7	79.4	112.8	87.9	54.3	38.9	53.2	55.7	48.0	50.7	90.0
80%		53.7	48.0	74.0	97.7	66.4	40.0	30.5	40.1	51.3	44.0	47.2	80.3
90%		51.3	45.1	70.5	78.8	42.8	32.0	22.7	18.7	45.6	38.7	43.2	74.2
Long Term													
Full Simulation Period ^b		102.8	101.1	118.1	129.3	116.6	98.1	66.8	68.5	63.0	56.6	72.8	102.8
Water Year Types ^c													
Wet (32%)		85.0	77.9	91.5	97.9	67.4	47.0	30.0	37.1	50.9	49.4	47.3	82.0
Above Normal (16%)		122.8	119.7	121.0	128.0	113.5	79.3	50.8	57.4	60.6	47.9	51.1	77.7
Below Normal (13%)		86.1	81.0	109.9	129.6	127.0	102.3	66.0	73.4	64.9	47.6	69.1	118.3
Dry (24%)		102.9	105.7	128.9	147.1	141.7	127.6	88.6	87.3	65.6	59.5	98.2	117.6
Critical (15%)		135.0	141.9	162.3	168.8	175.0	175.9	128.3	112.6	85.7	85.0	112.7	135.9

Alternative 1

Alternative 1		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		165.1	180.0	186.8	184.3	166.4	139.4	99.7	80.1	78.3	71.6	103.6	139.1
20%		156.4	154.5	171.3	166.2	150.1	122.4	86.6	71.0	70.0	60.4	87.1	129.7
30%		151.9	143.3	162.8	158.8	131.6	105.1	68.8	64.7	62.4	55.2	80.5	121.2
40%		147.4	135.4	155.2	152.3	112.6	95.0	58.1	51.3	56.3	50.5	73.5	113.6
50%		143.2	130.9	150.3	144.5	104.5	85.4	51.9	48.1	53.3	48.2	64.1	112.0
60%		136.7	124.2	144.5	114.2	91.4	71.5	43.3	43.5	50.2	45.5	54.9	108.0
70%		131.6	117.3	128.5	95.3	76.0	56.8	38.1	40.1	47.6	44.0	51.3	104.5
80%		126.3	110.5	103.7	81.8	61.6	41.1	30.7	35.6	44.3	41.3	48.2	98.0
90%		105.6	85.7	72.7	73.2	42.4	34.0	23.0	18.6	35.0	35.8	42.9	83.6
Long Term													
Full Simulation Period ^b		137.5	129.7	140.6	128.6	104.7	86.7	57.4	50.8	56.1	53.4	69.2	110.5
Water Year Types ^c													
Wet (32%)		123.7	115.7	112.5	87.3	59.4	47.3	29.0	30.2	46.3	47.2	46.0	88.3
Above Normal (16%)		150.7	137.2	139.5	126.8	96.0	69.6	43.4	41.5	51.9	44.3	52.0	111.2
Below Normal (13%)		126.4	115.1	141.0	141.8	120.8	92.5	62.0	53.4	49.1	44.3	69.2	111.9
Dry (24%)		141.8	133.5	156.0	150.2	124.8	102.2	72.0	62.2	59.7	52.3	86.5	120.5
Critical (15%)		156.3	159.3	176.9	172.0	163.8	159.4	105.2	84.3	82.6	87.0	109.2	139.6

Alternative 1 minus No Action Alternative

Alternative 1 minus No Action Alternative		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		6.0	0.4	-1.6	5.9	-16.2	-34.7	-26.1	-29.9	-9.7	-4.4	-10.5	2.5
20%		6.4	8.5	3.1	-1.2	-2.9	-19.3	-18.0	-33.8	-4.3	-4.5	-10.2	1.1
30%		8.2	11.8	9.0	8.3	-14.5	-20.5	-16.9	-27.2	-4.2	-4.8	-7.8	3.6
40%		13.9	11.5	19.8	12.2	-23.6	-19.2	-16.7	-26.7	-6.8	-6.5	0.4	4.2
50%		19.9	25.6	48.7	12.4	-17.7	-15.6	-3.8	-15.1	-7.9	-4.6	-3.1	9.5
60%		74.4	58.5	53.6	-8.3	-12.7	-0.6	-0.8	-13.8	-9.1	-3.5	-1.6	12.3
70%		73.2	62.6	49.1	-17.6	-12.0	2.5	-0.9	-13.1	-8.2	-4.0	0.7	14.5
80%		72.6	62.5	29.7	-16.0	-4.8	1.1	0.1	-4.5	-7.0	-2.7	1.0	17.6
90%		54.3	40.6	2.3	-5.6	-0.4	2.1	0.3	-0.2	-10.6	-2.9	-0.3	9.4
Long Term													
Full Simulation Period ^b		34.7	28.7	22.5	-0.7	-11.9	-11.3	-9.4	-17.7	-6.9	-3.2	-3.6	7.7
Water Year Types ^c													
Wet (32%)		38.7	37.8	20.9	-10.6	-8.1	0.3	-0.9	-6.9	-4.6	-2.2	-1.2	6.3
Above Normal (16%)		28.0	17.5	18.5	-1.1	-17.5	-9.7	-7.4	-15.9	-8.7	-3.6	0.9	33.4
Below Normal (13%)		40.3	34.1	31.1	12.2	-6.1	-9.7	-4.0	-20.0	-15.8	-3.3	0.1	-6.4
Dry (24%)		38.9	27.9	27.1	3.1	-16.9	-25.4	-16.6	-25.1	-5.9	-7.2	-11.7	2.9
Critical (15%)		21.3	17.4	14.6	3.2	-11.2	-16.4	-23.1	-28.3	-3.1	2.0	-3.5	3.7

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.17.2. Jones Pumping Plant, Monthly Chloride Concentration

Statistic		Monthly Chloride Concentration (mg/L)											
		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative													
Probability of Exceedance ^a													
10%		159.1	179.5	188.5	178.4	182.6	174.1	125.8	110.0	87.9	76.0	114.1	136.6
20%		150.0	146.0	168.2	167.4	153.1	141.7	104.6	104.8	74.4	64.9	97.4	128.6
30%		143.7	131.4	153.7	150.5	146.1	125.6	85.6	91.9	66.5	60.0	88.3	117.6
40%		133.5	123.8	135.4	140.1	136.2	114.2	74.8	77.9	63.1	57.1	73.1	109.5
50%		123.3	105.3	101.6	132.1	122.2	101.1	55.7	63.2	61.3	52.8	67.2	102.5
60%		62.2	65.7	90.8	122.5	104.1	72.2	44.2	57.3	59.3	49.0	56.5	95.6
70%		58.4	54.7	79.4	112.8	87.9	54.3	38.9	53.2	55.7	48.0	50.7	90.0
80%		53.7	48.0	74.0	97.7	66.4	40.0	30.5	40.1	51.3	44.0	47.2	80.3
90%		51.3	45.1	70.5	78.8	42.8	32.0	22.7	18.7	45.6	38.7	43.2	74.2
Long Term													
Full Simulation Period ^b		102.8	101.1	118.1	129.3	116.6	98.1	66.8	68.5	63.0	56.6	72.8	102.8
Water Year Types ^c													
Wet (32%)		85.0	77.9	91.5	97.9	67.4	47.0	30.0	37.1	50.9	49.4	47.3	82.0
Above Normal (16%)		122.8	119.7	121.0	128.0	113.5	79.3	50.8	57.4	60.6	47.9	51.1	77.7
Below Normal (13%)		86.1	81.0	109.9	129.6	127.0	102.3	66.0	73.4	64.9	47.6	69.1	118.3
Dry (24%)		102.9	105.7	128.9	147.1	141.7	127.6	88.6	87.3	65.6	59.5	98.2	117.6
Critical (15%)		135.0	141.9	162.3	168.8	175.0	175.9	128.3	112.6	85.7	85.0	112.7	135.9

Alternative 3

Statistic		Monthly Chloride Concentration (mg/L)											
		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		164.9	178.7	187.1	180.1	181.1	171.3	126.0	114.2	70.5	77.3	115.9	139.9
20%		156.3	153.1	171.1	171.9	159.1	141.8	99.3	100.0	63.8	64.8	96.1	131.1
30%		152.5	141.4	161.3	163.0	144.8	124.5	85.6	85.6	58.7	59.3	83.7	124.3
40%		146.4	134.5	157.6	155.2	133.3	111.6	63.3	72.0	55.1	54.7	74.6	116.9
50%		139.3	129.9	151.5	150.0	119.2	92.7	54.5	55.0	51.3	51.6	66.1	112.3
60%		135.6	126.4	143.9	131.8	99.6	75.8	41.4	49.3	48.7	49.5	55.3	107.7
70%		130.3	121.5	129.9	120.0	80.7	56.0	37.8	44.0	45.2	46.8	49.9	103.6
80%		125.1	111.4	103.6	92.3	61.2	39.5	29.2	37.3	41.4	44.4	45.9	98.7
90%		105.5	90.3	79.1	75.0	36.9	32.3	22.6	18.8	34.7	37.5	40.9	78.5
Long Term													
Full Simulation Period ^b		137.2	131.8	141.8	134.6	113.9	96.1	64.7	65.3	53.4	56.6	71.1	110.8
Water Year Types ^c													
Wet (32%)		122.4	117.6	115.8	97.4	61.8	46.8	28.7	33.4	44.3	49.6	45.0	85.0
Above Normal (16%)		153.8	142.6	143.3	138.4	106.9	73.6	45.7	48.7	47.1	47.4	51.7	112.4
Below Normal (13%)		126.1	114.1	142.0	145.2	125.2	98.4	66.2	72.8	49.9	49.7	72.1	122.0
Dry (24%)		139.4	136.6	157.7	155.3	142.3	124.7	85.9	83.8	54.8	57.8	92.9	120.0
Critical (15%)		157.7	159.1	169.7	166.7	176.8	177.4	126.8	114.7	81.1	86.0	111.2	139.4

Alternative 3 minus No Action Alternative

Statistic		Monthly Chloride Concentration (mg/L)											
		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		5.8	-0.9	-1.3	1.8	-1.5	-2.8	0.1	4.2	-17.4	1.3	1.9	3.2
20%		6.4	7.1	2.9	4.5	6.0	0.1	-5.4	-4.8	-10.6	-0.1	-1.3	2.5
30%		8.8	10.0	7.5	12.5	-1.3	-1.0	0.0	-6.2	-7.8	-0.7	-4.5	6.7
40%		12.9	10.7	22.3	15.1	-2.9	-2.6	-11.6	-6.0	-8.0	-2.4	1.5	7.5
50%		16.0	24.6	49.9	17.9	-3.0	-8.4	-1.2	-8.2	-10.0	-1.2	-1.1	9.8
60%		73.4	60.7	53.1	9.3	-4.5	3.7	-2.8	-8.0	-10.6	0.5	-1.2	12.1
70%		72.0	66.9	50.5	7.2	-7.3	1.7	-1.1	-9.1	-10.6	-1.2	-0.7	13.6
80%		71.4	63.3	29.6	-5.4	-5.2	-0.5	-1.3	-2.8	-10.0	0.3	-1.3	18.4
90%		54.2	45.2	8.6	-3.8	-5.9	0.4	-0.1	0.1	-10.9	-1.2	-2.3	4.3
Long Term													
Full Simulation Period ^b		34.4	30.7	23.6	5.3	-2.7	-2.0	-2.1	-3.2	-9.6	0.0	-1.7	8.0
Water Year Types ^c													
Wet (32%)		37.4	39.7	24.2	-0.5	-5.7	-0.2	-1.3	-3.8	-6.6	0.2	-2.3	3.0
Above Normal (16%)		31.1	22.9	22.2	10.4	-6.6	-5.7	-5.1	-8.7	-13.5	-0.4	0.5	34.7
Below Normal (13%)		40.0	33.2	32.1	15.7	-1.8	-3.9	0.3	-0.6	-15.1	2.1	3.0	3.7
Dry (24%)		36.5	30.9	28.9	8.2	0.6	-2.9	-2.7	-3.5	-10.8	-1.7	-5.2	2.4
Critical (15%)		22.7	17.2	7.4	-2.1	1.9	1.5	-1.4	2.1	-4.6	1.0	-1.5	3.4

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.17.3. Jones Pumping Plant, Monthly Chloride Concentration

No Action Alternative												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	159.1	179.5	188.5	178.4	182.6	174.1	125.8	110.0	87.9	76.0	114.1	136.6
20%	150.0	146.0	168.2	167.4	153.1	141.7	104.6	104.8	74.4	64.9	97.4	128.6
30%	143.7	131.4	153.7	150.5	146.1	125.6	85.6	91.9	66.5	60.0	88.3	117.6
40%	133.5	123.8	135.4	140.1	136.2	114.2	74.8	77.9	63.1	57.1	73.1	109.5
50%	123.3	105.3	101.6	132.1	122.2	101.1	55.7	63.2	61.3	52.8	67.2	102.5
60%	62.2	65.7	90.8	122.5	104.1	72.2	44.2	57.3	59.3	49.0	56.5	95.6
70%	58.4	54.7	79.4	112.8	87.9	54.3	38.9	53.2	55.7	48.0	50.7	90.0
80%	53.7	48.0	74.0	97.7	66.4	40.0	30.5	40.1	51.3	44.0	47.2	80.3
90%	51.3	45.1	70.5	78.8	42.8	32.0	22.7	18.7	45.6	38.7	43.2	74.2
Long Term												
Full Simulation Period ^b	102.8	101.1	118.1	129.3	116.6	98.1	66.8	68.5	63.0	56.6	72.8	102.8
Water Year Types ^c												
Wet (32%)	85.0	77.9	91.5	97.9	67.4	47.0	30.0	37.1	50.9	49.4	47.3	82.0
Above Normal (16%)	122.8	119.7	121.0	128.0	113.5	79.3	50.8	57.4	60.6	47.9	51.1	77.7
Below Normal (13%)	86.1	81.0	109.9	129.6	127.0	102.3	66.0	73.4	64.9	47.6	69.1	118.3
Dry (24%)	102.9	105.7	128.9	147.1	141.7	127.6	88.6	87.3	65.6	59.5	98.2	117.6
Critical (15%)	135.0	141.9	162.3	168.8	175.0	175.9	128.3	112.6	85.7	85.0	112.7	135.9

Alternative 5

Alternative 5												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	166.9	178.1	187.1	178.5	182.6	174.1	124.7	105.9	101.3	79.2	117.0	136.0
20%	151.7	152.4	166.1	167.5	154.8	141.7	105.5	102.2	81.0	66.2	102.3	129.6
30%	141.3	132.7	155.9	150.1	146.3	125.5	81.7	87.2	73.7	61.4	91.8	121.9
40%	135.6	124.7	137.1	139.8	136.2	114.2	71.2	73.0	68.7	58.6	73.9	113.5
50%	122.5	107.7	101.9	131.8	122.2	101.1	57.6	62.0	64.0	54.2	66.5	103.3
60%	63.2	66.2	90.9	122.6	104.2	72.2	44.2	54.3	61.6	50.9	56.8	96.7
70%	59.0	53.0	80.2	113.7	87.9	55.1	39.0	51.9	57.7	48.5	51.1	88.5
80%	53.9	48.2	72.3	97.8	66.4	40.4	30.3	40.1	52.3	44.4	47.8	80.5
90%	51.9	45.2	70.4	78.8	42.8	32.0	23.0	18.8	48.3	39.0	43.2	73.5
Long Term												
Full Simulation Period ^b	104.0	101.4	118.1	129.6	116.7	98.3	65.9	66.7	67.3	57.3	74.0	104.1
Water Year Types ^c												
Wet (32%)	85.6	79.0	92.2	97.8	67.5	47.5	30.0	35.6	51.0	49.8	47.5	82.1
Above Normal (16%)	125.9	118.9	119.7	127.6	113.5	79.3	49.9	54.2	61.2	48.0	51.3	77.7
Below Normal (13%)	86.0	81.5	109.9	129.5	126.8	102.2	65.7	73.7	68.5	48.4	69.3	119.8
Dry (24%)	104.2	105.5	128.5	148.6	142.4	127.7	87.2	88.5	74.6	62.3	102.4	121.0
Critical (15%)	136.1	142.2	162.4	169.2	174.9	176.2	125.8	105.1	96.4	83.5	113.2	137.8

Alternative 5 minus No Action Alternative

Alternative 5 minus No Action Alternative												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	7.8	-1.5	-1.3	0.2	0.0	0.0	-1.1	-4.1	13.4	3.1	2.9	-0.6
20%	1.7	6.4	-2.1	0.1	1.7	0.0	0.8	-2.7	6.6	1.3	4.9	1.0
30%	-2.4	1.3	2.2	-0.4	0.2	-0.1	-3.9	-4.6	7.1	1.3	3.5	4.3
40%	2.2	0.9	1.7	-0.3	0.0	0.0	-3.6	-5.0	5.7	1.5	0.8	4.1
50%	-0.8	2.4	0.3	-0.3	0.0	0.0	1.9	-1.3	2.7	1.4	-0.6	0.8
60%	0.9	0.5	0.1	0.1	0.1	0.0	0.0	-2.9	2.2	1.9	0.3	1.0
70%	0.7	-1.7	0.7	0.8	0.0	0.8	0.0	-1.3	2.0	0.4	0.4	-1.4
80%	0.1	0.2	-1.7	0.1	0.0	0.4	-0.2	0.0	1.0	0.4	0.6	0.2
90%	0.6	0.1	0.0	0.0	0.0	0.0	0.3	0.0	2.7	0.3	-0.1	-0.6
Long Term												
Full Simulation Period ^b	1.1	0.3	-0.1	0.4	0.1	0.2	-0.9	-1.8	4.3	0.7	1.2	1.3
Water Year Types ^c												
Wet (32%)	0.6	1.1	0.6	-0.1	0.0	0.5	0.0	-1.5	0.1	0.3	0.3	0.1
Above Normal (16%)	3.1	-0.8	-1.3	-0.3	0.0	0.0	-0.9	-3.2	0.5	0.1	0.1	-0.1
Below Normal (13%)	-0.1	0.5	0.0	-0.1	-0.2	-0.1	-0.2	0.3	3.5	0.8	0.2	1.5
Dry (24%)	1.3	-0.2	-0.4	1.6	0.7	0.1	-1.4	1.2	8.9	2.8	4.2	3.4
Critical (15%)	1.1	0.3	0.1	0.4	-0.1	0.4	-2.5	-7.6	10.7	-1.5	0.6	1.9

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.17.4. Jones Pumping Plant, Monthly Chloride Concentration

Second Basis of Comparison		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		165.1	180.0	186.8	184.3	166.4	139.4	99.7	80.1	78.3	71.6	103.6	139.1
20%		156.4	154.5	171.3	166.2	150.1	122.4	86.6	71.0	70.0	60.4	87.1	129.7
30%		151.9	143.3	162.8	158.8	131.6	105.1	68.8	64.7	62.4	55.2	80.5	121.2
40%		147.4	135.4	155.2	152.3	112.6	95.0	58.1	51.3	56.3	50.5	73.5	113.6
50%		143.2	130.9	150.3	144.5	104.5	85.4	51.9	48.1	53.3	48.2	64.1	112.0
60%		136.7	124.2	144.5	114.2	91.4	71.5	43.3	43.5	50.2	45.5	54.9	108.0
70%		131.6	117.3	128.5	95.3	76.0	56.8	38.1	40.1	47.6	44.0	51.3	104.5
80%		126.3	110.5	103.7	81.8	61.6	41.1	30.7	35.6	44.3	41.3	48.2	98.0
90%		105.6	85.7	72.7	73.2	42.4	34.0	23.0	18.6	35.0	35.8	42.9	83.6
Long Term													
Full Simulation Period ^b		137.5	129.7	140.6	128.6	104.7	86.7	57.4	50.8	56.1	53.4	69.2	110.5
Water Year Types ^c													
Wet (32%)		123.7	115.7	112.5	87.3	59.4	47.3	29.0	30.2	46.3	47.2	46.0	88.3
Above Normal (16%)		150.7	137.2	139.5	126.8	96.0	69.6	43.4	41.5	51.9	44.3	52.0	111.2
Below Normal (13%)		126.4	115.1	141.0	141.8	120.8	92.5	62.0	53.4	49.1	44.3	69.2	111.9
Dry (24%)		141.8	133.5	156.0	150.2	124.8	102.2	72.0	62.2	59.7	52.3	86.5	120.5
Critical (15%)		156.3	159.3	176.9	172.0	163.8	159.4	105.2	84.3	82.6	87.0	109.2	139.6

No Action Alternative

No Action Alternative		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		159.1	179.5	188.5	178.4	182.6	174.1	125.8	110.0	87.9	76.0	114.1	136.6
20%		150.0	146.0	168.2	167.4	153.1	141.7	104.6	104.8	74.4	64.9	97.4	128.6
30%		143.7	131.4	153.7	150.5	146.1	125.6	85.6	91.9	66.5	60.0	88.3	117.6
40%		133.5	123.8	135.4	140.1	136.2	114.2	74.8	77.9	63.1	57.1	73.1	109.5
50%		123.3	105.3	101.6	132.1	122.2	101.1	55.7	63.2	61.3	52.8	67.2	102.5
60%		62.2	65.7	90.8	122.5	104.1	72.2	44.2	57.3	59.3	49.0	56.5	95.6
70%		58.4	54.7	79.4	112.8	87.9	54.3	38.9	53.2	55.7	48.0	50.7	90.0
80%		53.7	48.0	74.0	97.7	66.4	40.0	30.5	40.1	51.3	44.0	47.2	80.3
90%		51.3	45.1	70.5	78.8	42.8	32.0	22.7	18.7	45.6	38.7	43.2	74.2
Long Term													
Full Simulation Period ^b		102.8	101.1	118.1	129.3	116.6	98.1	66.8	68.5	63.0	56.6	72.8	102.8
Water Year Types ^c													
Wet (32%)		85.0	77.9	91.5	97.9	67.4	47.0	30.0	37.1	50.9	49.4	47.3	82.0
Above Normal (16%)		122.8	119.7	121.0	128.0	113.5	79.3	50.8	57.4	60.6	47.9	51.1	77.7
Below Normal (13%)		86.1	81.0	109.9	129.6	127.0	102.3	66.0	73.4	64.9	47.6	69.1	118.3
Dry (24%)		102.9	105.7	128.9	147.1	141.7	127.6	88.6	87.3	65.6	59.5	98.2	117.6
Critical (15%)		135.0	141.9	162.3	168.8	175.0	175.9	128.3	112.6	85.7	85.0	112.7	135.9

No Action Alternative minus Second Basis of Comparison

No Action Alternative minus Second Basis of Comparison		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		-6.0	-0.4	1.6	-5.9	16.2	34.7	26.1	29.9	9.7	4.4	10.5	-2.5
20%		-6.4	-8.5	-3.1	1.2	2.9	19.3	18.0	33.8	4.3	4.5	10.2	-1.1
30%		-8.2	-11.8	-9.0	-8.3	14.5	20.5	16.9	27.2	4.2	4.8	7.8	-3.6
40%		-13.9	-11.5	-19.8	-12.2	23.6	19.2	16.7	26.7	6.8	6.5	-0.4	-4.2
50%		-19.9	-25.6	-48.7	-12.4	17.7	15.6	3.8	15.1	7.9	4.6	3.1	-9.5
60%		-74.4	-58.5	-53.6	8.3	12.7	0.6	0.8	13.8	9.1	3.5	1.6	-12.3
70%		-73.2	-62.6	-49.1	17.6	12.0	-2.5	0.9	13.1	8.2	4.0	-0.7	-14.5
80%		-72.6	-62.5	-29.7	16.0	4.8	-1.1	-0.1	4.5	7.0	2.7	-1.0	-17.6
90%		-54.3	-40.6	-2.3	5.6	0.4	-2.1	-0.3	0.2	10.6	2.9	0.3	-9.4
Long Term													
Full Simulation Period ^b		-34.7	-28.7	-22.5	0.7	11.9	11.3	9.4	17.7	6.9	3.2	3.6	-7.7
Water Year Types ^c													
Wet (32%)		-38.7	-37.8	-20.9	10.6	8.1	-0.3	0.9	6.9	4.6	2.2	1.2	-6.3
Above Normal (16%)		-28.0	-17.5	-18.5	1.1	17.5	9.7	7.4	15.9	8.7	3.6	-0.9	-33.4
Below Normal (13%)		-40.3	-34.1	-31.1	-12.2	6.1	9.7	4.0	20.0	15.8	3.3	-0.1	6.4
Dry (24%)		-38.9	-27.9	-27.1	-3.1	16.9	25.4	16.6	25.1	5.9	7.2	11.7	-2.9
Critical (15%)		-21.3	-17.4	-14.6	-3.2	11.2	16.4	23.1	28.3	3.1	-2.0	3.5	-3.7

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.17.5. Jones Pumping Plant, Monthly Chloride Concentration

Second Basis of Comparison

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	165.1	180.0	186.8	184.3	166.4	139.4	99.7	80.1	78.3	71.6	103.6	139.1
20%	156.4	154.5	171.3	166.2	150.1	122.4	86.6	71.0	70.0	60.4	87.1	129.7
30%	151.9	143.3	162.8	158.8	131.6	105.1	68.8	64.7	62.4	55.2	80.5	121.2
40%	147.4	135.4	155.2	152.3	112.6	95.0	58.1	51.3	56.3	50.5	73.5	113.6
50%	143.2	130.9	150.3	144.5	104.5	85.4	51.9	48.1	53.3	48.2	64.1	112.0
60%	136.7	124.2	144.5	114.2	91.4	71.5	43.3	43.5	50.2	45.5	54.9	108.0
70%	131.6	117.3	128.5	95.3	76.0	56.8	38.1	40.1	47.6	44.0	51.3	104.5
80%	126.3	110.5	103.7	81.8	61.6	41.1	30.7	35.6	44.3	41.3	48.2	98.0
90%	105.6	85.7	72.7	73.2	42.4	34.0	23.0	18.6	35.0	35.8	42.9	83.6
Long Term												
Full Simulation Period ^b	137.5	129.7	140.6	128.6	104.7	86.7	57.4	50.8	56.1	53.4	69.2	110.5
Water Year Types ^c												
Wet (32%)	123.7	115.7	112.5	87.3	59.4	47.3	29.0	30.2	46.3	47.2	46.0	88.3
Above Normal (16%)	150.7	137.2	139.5	126.8	96.0	69.6	43.4	41.5	51.9	44.3	52.0	111.2
Below Normal (13%)	126.4	115.1	141.0	141.8	120.8	92.5	62.0	53.4	49.1	44.3	69.2	111.9
Dry (24%)	141.8	133.5	156.0	150.2	124.8	102.2	72.0	62.2	59.7	52.3	86.5	120.5
Critical (15%)	156.3	159.3	176.9	172.0	163.8	159.4	105.2	84.3	82.6	87.0	109.2	139.6

Alternative 3

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	164.9	178.7	187.1	180.1	181.1	171.3	126.0	114.2	70.5	77.3	115.9	139.9
20%	156.3	153.1	171.1	171.9	159.1	141.8	99.3	100.0	63.8	64.8	96.1	131.1
30%	152.5	141.4	161.3	163.0	144.8	124.5	85.6	85.6	58.7	59.3	83.7	124.3
40%	146.4	134.5	157.6	155.2	133.3	111.6	63.3	72.0	55.1	54.7	74.6	116.9
50%	139.3	129.9	151.5	150.0	119.2	92.7	54.5	55.0	51.3	51.6	66.1	112.3
60%	135.6	126.4	143.9	131.8	99.6	75.8	41.4	49.3	48.7	49.5	55.3	107.7
70%	130.3	121.5	129.9	120.0	80.7	56.0	37.8	44.0	45.2	46.8	49.9	103.6
80%	125.1	111.4	103.6	92.3	61.2	39.5	29.2	37.3	41.4	44.4	45.9	98.7
90%	105.5	90.3	79.1	75.0	36.9	32.3	22.6	18.8	34.7	37.5	40.9	78.5
Long Term												
Full Simulation Period ^b	137.2	131.8	141.8	134.6	113.9	96.1	64.7	65.3	53.4	56.6	71.1	110.8
Water Year Types ^c												
Wet (32%)	122.4	117.6	115.8	97.4	61.8	46.8	28.7	33.4	44.3	49.6	45.0	85.0
Above Normal (16%)	153.8	142.6	143.3	138.4	106.9	73.6	45.7	48.7	47.1	47.4	51.7	112.4
Below Normal (13%)	126.1	114.1	142.0	145.2	125.2	98.4	66.2	72.8	49.9	49.7	72.1	122.0
Dry (24%)	139.4	136.6	157.7	155.3	142.3	124.7	85.9	83.8	54.8	57.8	92.9	120.0
Critical (15%)	157.7	159.1	169.7	166.7	176.8	177.4	126.8	114.7	81.1	86.0	111.2	139.4

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.2	-1.3	0.3	-4.1	14.7	31.9	26.3	34.1	-7.8	5.6	12.3	0.7
20%	0.0	-1.5	-0.2	5.7	9.0	19.4	12.6	29.0	-6.2	4.4	8.9	1.4
30%	0.7	-1.8	-1.5	4.2	13.2	19.5	16.9	21.0	-3.6	4.1	3.3	3.1
40%	-0.9	-0.9	2.5	2.9	20.8	16.6	5.2	20.7	-1.2	4.1	1.1	3.3
50%	-3.8	-1.0	1.2	5.5	14.7	7.2	2.6	7.0	-2.1	3.4	2.0	0.3
60%	-1.1	2.3	-0.6	17.7	8.2	4.3	-2.0	5.8	-1.5	4.0	0.4	-0.2
70%	-1.3	4.3	1.4	24.7	4.7	-0.8	-0.3	4.0	-2.4	2.8	-1.4	-0.9
80%	-1.2	0.9	-0.1	10.5	-0.4	-1.6	-1.5	1.7	-3.0	3.1	-2.3	0.7
90%	-0.1	4.6	6.4	1.8	-5.5	-1.7	-0.4	0.2	-0.3	1.7	-2.0	-5.1
Long Term												
Full Simulation Period ^b	-0.3	2.1	1.2	6.0	9.2	9.4	7.4	14.5	-2.7	3.2	1.9	0.4
Water Year Types ^c												
Wet (32%)	-1.3	1.9	3.3	10.1	2.4	-0.5	-0.4	3.2	-2.0	2.4	-1.1	-3.2
Above Normal (16%)	3.1	5.4	3.8	11.6	10.8	4.0	2.3	7.2	-4.8	3.1	-0.4	1.2
Below Normal (13%)	-0.2	-0.9	1.0	3.5	4.3	5.9	4.3	19.4	0.8	5.4	2.9	10.1
Dry (24%)	-2.3	3.1	1.8	5.1	17.5	22.5	13.9	21.6	-4.9	5.5	6.4	-0.5
Critical (15%)	1.4	-0.1	-7.2	-5.3	13.1	17.9	21.6	30.4	-1.5	-1.0	2.0	-0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.17.6. Jones Pumping Plant, Monthly Chloride Concentration

Second Basis of Comparison		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		165.1	180.0	186.8	184.3	166.4	139.4	99.7	80.1	78.3	71.6	103.6	139.1
20%		156.4	154.5	171.3	166.2	150.1	122.4	86.6	71.0	70.0	60.4	87.1	129.7
30%		151.9	143.3	162.8	158.8	131.6	105.1	68.8	64.7	62.4	55.2	80.5	121.2
40%		147.4	135.4	155.2	152.3	112.6	95.0	58.1	51.3	56.3	50.5	73.5	113.6
50%		143.2	130.9	150.3	144.5	104.5	85.4	51.9	48.1	53.3	48.2	64.1	112.0
60%		136.7	124.2	144.5	114.2	91.4	71.5	43.3	43.5	50.2	45.5	54.9	108.0
70%		131.6	117.3	128.5	95.3	76.0	56.8	38.1	40.1	47.6	44.0	51.3	104.5
80%		126.3	110.5	103.7	81.8	61.6	41.1	30.7	35.6	44.3	41.3	48.2	98.0
90%		105.6	85.7	72.7	73.2	42.4	34.0	23.0	18.6	35.0	35.8	42.9	83.6
Long Term													
Full Simulation Period ^b		137.5	129.7	140.6	128.6	104.7	86.7	57.4	50.8	56.1	53.4	69.2	110.5
Water Year Types ^c													
Wet (32%)		123.7	115.7	112.5	87.3	59.4	47.3	29.0	30.2	46.3	47.2	46.0	88.3
Above Normal (16%)		150.7	137.2	139.5	126.8	96.0	69.6	43.4	41.5	51.9	44.3	52.0	111.2
Below Normal (13%)		126.4	115.1	141.0	141.8	120.8	92.5	62.0	53.4	49.1	44.3	69.2	111.9
Dry (24%)		141.8	133.5	156.0	150.2	124.8	102.2	72.0	62.2	59.7	52.3	86.5	120.5
Critical (15%)		156.3	159.3	176.9	172.0	163.8	159.4	105.2	84.3	82.6	87.0	109.2	139.6

Alternative 5

Alternative 5		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		166.9	178.1	187.1	178.5	182.6	174.1	124.7	105.9	101.3	79.2	117.0	136.0
20%		151.7	152.4	166.1	167.5	154.8	141.7	105.5	102.2	81.0	66.2	102.3	129.6
30%		141.3	132.7	155.9	150.1	146.3	125.5	81.7	87.2	73.7	61.4	91.8	121.9
40%		135.6	124.7	137.1	139.8	136.2	114.2	71.2	73.0	68.7	58.6	73.9	113.5
50%		122.5	107.7	101.9	131.8	122.2	101.1	57.6	62.0	64.0	54.2	66.5	103.3
60%		63.2	66.2	90.9	122.6	104.2	72.2	44.2	54.3	61.6	50.9	56.8	96.7
70%		59.0	53.0	80.2	113.7	87.9	55.1	39.0	51.9	57.7	48.5	51.1	88.5
80%		53.9	48.2	72.3	97.8	66.4	40.4	30.3	40.1	52.3	44.4	47.8	80.5
90%		51.9	45.2	70.4	78.8	42.8	32.0	23.0	18.8	48.3	39.0	43.2	73.5
Long Term													
Full Simulation Period ^b		104.0	101.4	118.1	129.6	116.7	98.3	65.9	66.7	67.3	57.3	74.0	104.1
Water Year Types ^c													
Wet (32%)		85.6	79.0	92.2	97.8	67.5	47.5	30.0	35.6	51.0	49.8	47.5	82.1
Above Normal (16%)		125.9	118.9	119.7	127.6	113.5	79.3	49.9	54.2	61.2	48.0	51.3	77.7
Below Normal (13%)		86.0	81.5	109.9	129.5	126.8	102.2	65.7	73.7	68.5	48.4	69.3	119.8
Dry (24%)		104.2	105.5	128.5	148.6	142.4	127.7	87.2	88.5	74.6	62.3	102.4	121.0
Critical (15%)		136.1	142.2	162.4	169.2	174.9	176.2	125.8	105.1	96.4	83.5	113.2	137.8

Alternative 5 minus Second Basis of Comparison

Alternative 5 minus Second Basis of Comparison		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		1.8	-1.9	0.3	-5.7	16.2	34.7	25.0	25.8	23.0	7.5	13.4	-3.1
20%		-4.7	-2.2	-5.2	1.3	4.6	19.2	18.9	31.2	10.9	5.8	15.2	0.0
30%		-10.6	-10.5	-6.9	-8.7	14.7	20.4	13.0	22.5	11.3	6.2	11.3	0.7
40%		-11.7	-10.7	-18.1	-12.5	23.6	19.2	13.1	21.7	12.4	8.1	0.4	-0.1
50%		-20.7	-23.2	-48.4	-12.7	17.7	15.6	5.7	13.9	10.7	6.0	2.5	-8.7
60%		-73.5	-58.0	-53.5	8.4	12.8	0.6	0.8	10.8	11.3	5.4	1.9	-11.3
70%		-72.6	-64.3	-48.4	18.4	12.0	-1.7	0.9	11.8	10.2	4.5	-0.3	-15.9
80%		-72.5	-62.3	-31.4	16.1	4.8	-0.7	-0.3	4.5	8.0	3.1	-0.4	-17.4
90%		-53.7	-40.5	-2.3	5.6	0.4	-2.1	0.0	0.2	13.3	3.3	0.3	-10.0
Long Term													
Full Simulation Period ^b		-33.6	-28.4	-22.5	1.0	12.1	11.5	8.6	15.9	11.2	3.9	4.8	-6.4
Water Year Types ^c													
Wet (32%)		-38.1	-36.7	-20.3	10.5	8.1	0.1	1.0	5.4	4.7	2.6	1.5	-6.2
Above Normal (16%)		-24.9	-18.3	-19.7	0.8	17.5	9.7	6.5	12.7	9.3	3.7	-0.8	-33.5
Below Normal (13%)		-40.4	-33.6	-31.1	-12.2	6.0	9.7	3.7	20.3	19.3	4.2	0.1	7.9
Dry (24%)		-37.6	-28.1	-27.4	-1.6	17.6	25.4	15.2	26.3	14.8	10.0	15.9	0.5
Critical (15%)		-20.2	-17.0	-14.4	-2.8	11.1	16.8	20.6	20.8	13.8	-3.5	4.0	-1.8

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1
2

B.18. Banks Pumping Plant Chloride Concentration

Table 6E.B.18.1. Banks Pumping Plant, Monthly Chloride Concentration

No Action Alternative		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		169.9	187.4	203.2	187.8	141.3	125.2	108.4	96.5	87.0	73.0	111.3	135.5
20%		156.4	148.1	167.6	168.1	121.7	103.2	92.8	88.8	71.2	53.7	88.3	124.6
30%		145.0	135.0	145.3	135.0	108.7	90.5	78.5	81.7	61.9	45.5	71.0	114.5
40%		140.5	129.1	124.0	113.6	102.7	81.8	69.6	72.9	56.3	41.8	60.3	102.6
50%		122.5	110.0	75.2	103.1	94.3	69.9	62.2	57.1	52.8	38.7	55.8	99.0
60%		57.4	48.8	56.6	94.6	88.1	64.0	47.5	49.6	49.5	35.7	44.6	94.6
70%		52.7	42.0	45.3	79.4	73.9	55.2	38.8	44.1	46.3	33.1	39.6	86.3
80%		47.0	38.6	37.5	71.6	56.1	46.0	32.9	38.0	41.8	30.5	35.2	76.8
90%		40.4	34.5	34.1	64.8	49.1	35.2	24.8	17.7	30.6	28.2	31.5	70.3
Long Term													
Full Simulation Period ^b		102.4	98.7	101.8	114.0	95.0	76.5	64.7	61.8	57.1	45.4	62.4	99.7
Water Year Types ^c													
Wet (32%)		84.0	72.1	67.4	76.6	62.4	44.8	31.3	32.2	39.4	33.5	37.2	82.6
Above Normal (16%)		124.1	120.7	108.7	109.1	92.8	66.4	52.2	51.7	50.3	31.5	38.4	73.7
Below Normal (13%)		86.1	74.8	88.3	111.8	100.5	82.2	68.8	68.9	62.0	38.4	57.7	116.0
Dry (24%)		100.7	103.4	113.1	136.5	108.7	91.2	82.3	76.5	60.4	49.6	89.5	113.8
Critical (15%)		136.3	146.4	162.4	164.8	140.1	126.2	117.4	106.1	92.6	85.5	102.5	126.5

Alternative 1

Alternative 1		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		166.0	185.8	193.1	193.8	142.0	105.3	80.7	69.3	71.3	67.6	99.2	131.1
20%		159.4	159.2	176.8	179.0	123.6	83.0	68.8	63.8	63.0	48.1	73.6	125.4
30%		157.2	149.8	167.2	158.0	100.3	72.4	56.4	58.1	47.0	42.9	66.5	116.8
40%		150.0	140.9	156.1	148.6	83.3	65.2	50.9	45.0	42.4	40.1	61.4	110.6
50%		146.0	136.6	148.1	140.5	77.9	60.0	45.8	41.2	39.2	37.6	52.1	106.4
60%		142.6	130.8	140.7	84.4	67.2	53.2	41.7	36.8	36.6	33.9	42.4	103.6
70%		135.7	123.4	124.7	69.5	56.9	45.8	37.3	35.3	34.6	30.9	38.5	100.6
80%		129.3	113.8	93.0	62.1	50.5	40.1	31.6	31.2	31.8	28.6	35.4	89.1
90%		112.7	85.2	45.2	50.0	39.9	34.7	22.4	19.9	29.5	27.1	31.9	82.3
Long Term													
Full Simulation Period ^b		140.5	134.4	137.7	122.0	85.7	64.3	51.6	47.2	45.8	42.9	57.9	106.4
Water Year Types ^c													
Wet (32%)		127.3	120.0	106.7	70.3	50.1	41.9	29.3	27.2	34.4	33.3	35.8	86.9
Above Normal (16%)		151.8	140.2	135.0	118.9	75.9	55.4	41.3	36.8	35.9	30.1	38.9	108.0
Below Normal (13%)		130.8	119.2	135.1	136.5	109.9	76.2	57.9	48.8	37.0	33.7	58.6	107.7
Dry (24%)		144.9	139.3	155.6	149.5	97.9	68.1	57.4	55.9	50.8	45.1	74.3	116.0
Critical (15%)		158.4	165.1	180.6	178.5	131.0	105.5	95.8	86.0	81.2	82.5	98.4	129.7

Alternative 1 minus No Action Alternative

Alternative 1 minus No Action Alternative		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		-3.9	-1.6	-10.1	6.1	0.8	-19.9	-27.7	-27.1	-15.6	-5.5	-12.2	-4.4
20%		3.0	11.1	9.3	10.9	1.8	-20.2	-24.0	-24.9	-8.1	-5.6	-14.7	0.9
30%		12.1	14.8	22.0	23.1	-8.3	-18.1	-22.0	-23.6	-14.9	-2.6	-4.5	2.3
40%		9.5	11.8	32.1	35.1	-19.3	-16.6	-18.7	-27.9	-13.9	-1.7	1.0	8.0
50%		23.5	26.5	72.9	37.3	-16.4	-10.0	-16.4	-15.8	-13.6	-1.1	-3.8	7.4
60%		85.2	82.0	84.1	-10.2	-20.8	-10.8	-5.8	-12.9	-12.9	-1.8	-2.3	9.0
70%		83.1	81.4	79.4	-10.0	-17.0	-9.4	-1.5	-8.8	-11.8	-2.2	-1.1	14.3
80%		82.3	75.1	55.4	-9.5	-5.6	-6.0	-1.2	-6.8	-10.0	-1.9	0.2	12.3
90%		72.3	50.8	11.2	-14.8	-9.2	-0.5	-2.4	2.2	-1.1	-1.0	0.4	12.0
Long Term													
Full Simulation Period ^b		38.1	35.7	35.9	8.0	-9.3	-12.2	-13.0	-14.6	-11.2	-2.5	-4.5	6.7
Water Year Types ^c													
Wet (32%)		43.3	47.9	39.2	-6.3	-12.3	-3.0	-2.0	-4.9	-5.0	-0.2	-1.4	4.4
Above Normal (16%)		27.7	19.5	26.3	9.8	-16.9	-11.0	-10.9	-14.9	-14.4	-1.4	0.5	34.3
Below Normal (13%)		44.7	44.4	46.8	24.6	9.4	-6.0	-10.9	-20.1	-25.0	-4.7	0.9	-8.3
Dry (24%)		44.2	35.9	42.6	13.0	-10.8	-23.1	-24.9	-20.7	-9.6	-4.5	-15.2	2.2
Critical (15%)		22.1	18.7	18.1	13.7	-9.2	-20.7	-21.6	-20.1	-11.5	-3.0	-4.1	3.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.18.2. Banks Pumping Plant, Monthly Chloride Concentration

No Action Alternative												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	169.9	187.4	203.2	187.8	141.3	125.2	108.4	96.5	87.0	73.0	111.3	135.5
20%	156.4	148.1	167.6	168.1	121.7	103.2	92.8	88.8	71.2	53.7	88.3	124.6
30%	145.0	135.0	145.3	135.0	108.7	90.5	78.5	81.7	61.9	45.5	71.0	114.5
40%	140.5	129.1	124.0	113.6	102.7	81.8	69.6	72.9	56.3	41.8	60.3	102.6
50%	122.5	110.0	75.2	103.1	94.3	69.9	62.2	57.1	52.8	38.7	55.8	99.0
60%	57.4	48.8	56.6	94.6	88.1	64.0	47.5	49.6	49.5	35.7	44.6	94.6
70%	52.7	42.0	45.3	79.4	73.9	55.2	38.8	44.1	46.3	33.1	39.6	86.3
80%	47.0	38.6	37.5	71.6	56.1	46.0	32.9	38.0	41.8	30.5	35.2	76.8
90%	40.4	34.5	34.1	64.8	49.1	35.2	24.8	17.7	30.6	28.2	31.5	70.3
Long Term												
Full Simulation Period ^b	102.4	98.7	101.8	114.0	95.0	76.5	64.7	61.8	57.1	45.4	62.4	99.7
Water Year Types^c												
Wet (32%)	84.0	72.1	67.4	76.6	62.4	44.8	31.3	32.2	39.4	33.5	37.2	82.6
Above Normal (16%)	124.1	120.7	108.7	109.1	92.8	66.4	52.2	51.7	50.3	31.5	38.4	73.7
Below Normal (13%)	86.1	74.8	88.3	111.8	100.5	82.2	68.8	68.9	62.0	38.4	57.7	116.0
Dry (24%)	100.7	103.4	113.1	136.5	108.7	91.2	82.3	76.5	60.4	49.6	89.5	113.8
Critical (15%)	136.3	146.4	162.4	164.8	140.1	126.2	117.4	106.1	92.6	85.5	102.5	126.5

Alternative 3												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	172.3	185.8	196.2	192.0	136.6	116.0	103.4	91.5	63.5	70.8	113.3	139.8
20%	159.3	160.5	175.1	177.8	120.1	99.5	90.4	78.3	52.5	50.0	79.8	128.9
30%	151.8	147.4	164.1	165.5	110.5	87.9	74.2	61.9	44.8	43.2	67.8	118.4
40%	149.3	141.0	157.8	149.9	96.8	76.9	61.0	48.4	39.3	41.0	61.6	113.4
50%	145.0	133.7	149.3	139.1	89.8	63.3	50.3	43.1	35.7	39.1	54.6	108.5
60%	138.6	131.8	140.0	96.4	77.3	57.2	43.0	37.6	33.7	35.8	44.3	103.1
70%	133.0	126.7	125.1	82.5	67.9	49.2	36.9	33.8	31.4	31.4	37.4	100.1
80%	127.8	113.4	97.1	69.8	52.0	39.6	31.3	31.1	28.9	29.0	35.7	90.7
90%	112.8	97.7	46.3	60.0	39.6	35.4	25.0	21.0	27.2	27.0	29.9	77.2
Long Term												
Full Simulation Period ^b	139.6	136.6	138.9	126.3	89.1	71.8	59.3	51.7	43.3	44.1	60.3	107.3
Water Year Types^c												
Wet (32%)	125.9	121.7	110.3	81.3	54.4	41.7	29.8	27.5	30.4	32.9	35.6	83.9
Above Normal (16%)	154.7	146.8	138.6	129.7	87.2	58.7	42.9	36.7	32.5	30.2	38.6	109.6
Below Normal (13%)	130.6	117.6	135.3	142.5	102.2	77.3	62.7	56.0	40.6	38.5	61.9	120.5
Dry (24%)	141.3	142.1	157.8	153.2	104.9	86.6	74.6	62.1	44.6	47.9	82.5	115.6
Critical (15%)	158.5	166.4	173.2	160.3	128.1	121.7	112.4	99.3	83.3	82.1	98.9	129.7

Alternative 3 minus No Action Alternative												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2.4	-1.6	-7.0	4.3	-4.7	-9.3	-5.0	-4.9	-23.4	-2.2	2.0	4.3
20%	2.9	12.4	7.5	9.7	-1.6	-3.7	-2.4	-10.5	-18.7	-3.7	-8.5	4.4
30%	6.7	12.4	18.8	30.5	1.9	-2.5	-4.3	-19.8	-17.1	-2.3	-3.1	4.0
40%	8.9	11.9	33.9	36.3	-5.9	-4.9	-8.6	-24.5	-17.0	-0.8	1.3	10.8
50%	22.5	23.6	74.1	36.0	-4.5	-6.6	-11.9	-13.9	-17.1	0.4	-1.3	9.4
60%	81.2	83.0	83.4	1.8	-10.8	-6.8	-4.5	-12.0	-15.9	0.1	-0.3	8.5
70%	80.3	84.7	79.8	3.0	-6.1	-6.0	-1.9	-10.3	-14.9	-1.7	-2.2	13.8
80%	80.8	74.8	59.5	-1.8	-4.0	-6.4	-1.6	-6.9	-12.8	-1.4	0.5	13.9
90%	72.4	63.2	12.2	-4.8	-9.5	0.2	0.2	3.3	-3.4	-1.2	-1.7	6.9
Long Term												
Full Simulation Period ^b	37.3	38.0	37.1	12.3	-5.9	-4.7	-5.4	-10.1	-13.8	-1.3	-2.1	7.6
Water Year Types^c												
Wet (32%)	41.9	49.6	42.9	4.7	-8.0	-3.2	-1.5	-4.7	-9.0	-0.6	-1.6	1.4
Above Normal (16%)	30.6	26.1	29.9	20.7	-5.6	-7.7	-9.3	-15.0	-17.8	-1.3	0.3	35.8
Below Normal (13%)	44.5	42.7	47.1	30.7	1.7	-5.0	-6.1	-12.9	-21.5	0.1	4.1	4.5
Dry (24%)	40.6	38.7	44.7	16.7	-3.8	-4.7	-7.6	-14.5	-15.8	-1.7	-7.0	1.7
Critical (15%)	22.2	20.1	10.8	-4.5	-12.0	-4.4	-5.1	-6.8	-9.3	-3.4	-3.6	3.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.18.3. Banks Pumping Plant, Monthly Chloride Concentration

No Action Alternative												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	169.9	187.4	203.2	187.8	141.3	125.2	108.4	96.5	87.0	73.0	111.3	135.5
20%	156.4	148.1	167.6	168.1	121.7	103.2	92.8	88.8	71.2	53.7	88.3	124.6
30%	145.0	135.0	145.3	135.0	108.7	90.5	78.5	81.7	61.9	45.5	71.0	114.5
40%	140.5	129.1	124.0	113.6	102.7	81.8	69.6	72.9	56.3	41.8	60.3	102.6
50%	122.5	110.0	75.2	103.1	94.3	69.9	62.2	57.1	52.8	38.7	55.8	99.0
60%	57.4	48.8	56.6	94.6	88.1	64.0	47.5	49.6	49.5	35.7	44.6	94.6
70%	52.7	42.0	45.3	79.4	73.9	55.2	38.8	44.1	46.3	33.1	39.6	86.3
80%	47.0	38.6	37.5	71.6	56.1	46.0	32.9	38.0	41.8	30.5	35.2	76.8
90%	40.4	34.5	34.1	64.8	49.1	35.2	24.8	17.7	30.6	28.2	31.5	70.3
Long Term												
Full Simulation Period ^b	102.4	98.7	101.8	114.0	95.0	76.5	64.7	61.8	57.1	45.4	62.4	99.7
Water Year Types ^c												
Wet (32%)	84.0	72.1	67.4	76.6	62.4	44.8	31.3	32.2	39.4	33.5	37.2	82.6
Above Normal (16%)	124.1	120.7	108.7	109.1	92.8	66.4	52.2	51.7	50.3	31.5	38.4	73.7
Below Normal (13%)	86.1	74.8	88.3	111.8	100.5	82.2	68.8	68.9	62.0	38.4	57.7	116.0
Dry (24%)	100.7	103.4	113.1	136.5	108.7	91.2	82.3	76.5	60.4	49.6	89.5	113.8
Critical (15%)	136.3	146.4	162.4	164.8	140.1	126.2	117.4	106.1	92.6	85.5	102.5	126.5

Alternative 5												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	168.9	188.6	203.7	188.5	141.3	125.1	118.5	109.3	103.1	80.2	114.0	135.3
20%	159.9	158.7	169.7	167.8	122.1	103.3	96.7	95.4	82.2	59.0	94.3	125.6
30%	147.0	135.9	146.0	134.8	108.8	90.5	82.6	83.1	74.9	47.5	77.1	118.7
40%	141.8	130.7	124.0	113.1	102.8	81.6	69.2	65.4	60.9	42.3	61.8	112.6
50%	128.1	113.1	75.4	102.3	94.5	70.0	62.9	55.6	53.5	39.5	56.0	100.0
60%	58.5	48.5	56.6	94.6	88.1	63.9	47.6	47.7	49.7	37.0	44.6	95.0
70%	52.9	41.1	45.4	79.4	74.0	55.9	39.1	43.4	46.7	33.3	39.6	89.2
80%	48.5	39.0	36.7	71.8	57.5	46.1	32.7	37.8	44.5	30.2	34.3	77.3
90%	40.8	34.6	34.4	65.1	49.0	35.8	24.9	17.9	30.8	28.6	30.0	69.1
Long Term												
Full Simulation Period ^b	103.7	99.6	101.8	114.3	95.3	76.9	66.5	64.0	62.7	46.7	64.3	101.4
Water Year Types ^c												
Wet (32%)	84.5	73.5	69.0	76.6	62.6	45.1	31.4	31.1	39.2	33.5	37.1	82.3
Above Normal (16%)	127.7	122.8	106.9	108.6	92.8	66.4	51.7	49.0	50.1	31.7	38.3	73.5
Below Normal (13%)	85.8	75.4	88.4	111.7	100.3	82.0	68.5	64.8	64.1	39.4	57.9	117.8
Dry (24%)	102.4	103.4	112.1	138.6	109.8	91.6	85.6	82.7	72.6	52.7	96.0	118.3
Critical (15%)	137.7	146.7	162.3	164.2	140.4	127.7	124.6	119.3	109.9	88.4	104.2	129.8

Alternative 5 minus No Action Alternative												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.9	1.2	0.5	0.8	0.0	-0.1	10.1	12.8	16.2	7.1	2.6	-0.2
20%	3.5	10.5	2.2	-0.3	0.4	0.1	4.0	6.6	11.0	5.3	6.0	1.0
30%	2.0	1.0	0.8	-0.1	0.1	0.0	4.1	1.4	13.0	2.0	6.1	4.2
40%	1.3	1.6	0.0	-0.4	0.2	-0.1	-0.4	-7.4	4.6	0.6	1.5	9.9
50%	5.6	3.0	0.2	-0.8	0.1	0.1	0.7	-1.5	0.7	0.8	0.2	0.9
60%	1.1	-0.2	0.0	0.0	0.0	-0.1	0.0	-2.0	0.1	1.3	-0.1	0.4
70%	0.2	-1.0	0.2	0.0	0.1	0.6	0.3	-0.7	0.4	0.2	0.0	2.8
80%	1.5	0.3	-0.9	0.2	1.4	0.0	-0.2	-0.2	2.7	-0.3	-0.9	0.5
90%	0.4	0.2	0.3	0.3	0.0	0.6	0.1	0.2	0.2	0.4	-1.5	-1.2
Long Term												
Full Simulation Period ^b	1.3	0.9	0.0	0.3	0.3	0.4	1.8	2.1	5.6	1.4	1.8	1.7
Water Year Types ^c												
Wet (32%)	0.5	1.4	1.6	0.0	0.1	0.3	0.1	-1.1	-0.2	0.0	-0.1	-0.3
Above Normal (16%)	3.6	2.1	-1.8	-0.5	0.0	0.0	-0.5	-2.7	-0.2	0.2	-0.1	-0.3
Below Normal (13%)	-0.3	0.6	0.2	-0.2	-0.2	-0.2	-0.3	-4.1	2.0	1.0	0.2	1.8
Dry (24%)	1.7	0.0	-1.0	2.1	1.2	0.4	3.3	6.2	12.1	3.1	6.5	4.5
Critical (15%)	1.4	0.3	-0.2	-0.6	0.2	1.5	7.2	13.2	17.2	2.9	1.7	3.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.18.4. Banks Pumping Plant, Monthly Chloride Concentration

Second Basis of Comparison		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a													
10%		166.0	185.8	193.1	193.8	142.0	105.3	80.7	69.3	71.3	67.6	99.2	131.1
20%		159.4	159.2	176.8	179.0	123.6	83.0	68.8	63.8	63.0	48.1	73.6	125.4
30%		157.2	149.8	167.2	158.0	100.3	72.4	56.4	58.1	47.0	42.9	66.5	116.8
40%		150.0	140.9	156.1	148.6	83.3	65.2	50.9	45.0	42.4	40.1	61.4	110.6
50%		146.0	136.6	148.1	140.5	77.9	60.0	45.8	41.2	39.2	37.6	52.1	106.4
60%		142.6	130.8	140.7	84.4	67.2	53.2	41.7	36.8	36.6	33.9	42.4	103.6
70%		135.7	123.4	124.7	69.5	56.9	45.8	37.3	35.3	34.6	30.9	38.5	100.6
80%		129.3	113.8	93.0	62.1	50.5	40.1	31.6	31.2	31.8	28.6	35.4	89.1
90%		112.7	85.2	45.2	50.0	39.9	34.7	22.4	19.9	29.5	27.1	31.9	82.3
Long Term													
Full Simulation Period ^b		140.5	134.4	137.7	122.0	85.7	64.3	51.6	47.2	45.8	42.9	57.9	106.4
Water Year Types^c													
Wet (32%)		127.3	120.0	106.7	70.3	50.1	41.9	29.3	27.2	34.4	33.3	35.8	86.9
Above Normal (16%)		151.8	140.2	135.0	118.9	75.9	55.4	41.3	36.8	35.9	30.1	38.9	108.0
Below Normal (13%)		130.8	119.2	135.1	136.5	109.9	76.2	57.9	48.8	37.0	33.7	58.6	107.7
Dry (24%)		144.9	139.3	155.6	149.5	97.9	68.1	57.4	55.9	50.8	45.1	74.3	116.0
Critical (15%)		158.4	165.1	180.6	178.5	131.0	105.5	95.8	86.0	81.2	82.5	98.4	129.7

No Action Alternative		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a													
10%		169.9	187.4	203.2	187.8	141.3	125.2	108.4	96.5	87.0	73.0	111.3	135.5
20%		156.4	148.1	167.6	168.1	121.7	103.2	92.8	88.8	71.2	53.7	88.3	124.6
30%		145.0	135.0	145.3	135.0	108.7	90.5	78.5	81.7	61.9	45.5	71.0	114.5
40%		140.5	129.1	124.0	113.6	102.7	81.8	69.6	72.9	56.3	41.8	60.3	102.6
50%		122.5	110.0	75.2	103.1	94.3	69.9	62.2	57.1	52.8	38.7	55.8	99.0
60%		57.4	48.8	56.6	94.6	88.1	64.0	47.5	49.6	49.5	35.7	44.6	94.6
70%		52.7	42.0	45.3	79.4	73.9	55.2	38.8	44.1	46.3	33.1	39.6	86.3
80%		47.0	38.6	37.5	71.6	56.1	46.0	32.9	38.0	41.8	30.5	35.2	76.8
90%		40.4	34.5	34.1	64.8	49.1	35.2	24.8	17.7	30.6	28.2	31.5	70.3
Long Term													
Full Simulation Period ^b		102.4	98.7	101.8	114.0	95.0	76.5	64.7	61.8	57.1	45.4	62.4	99.7
Water Year Types^c													
Wet (32%)		84.0	72.1	67.4	76.6	62.4	44.8	31.3	32.2	39.4	33.5	37.2	82.6
Above Normal (16%)		124.1	120.7	108.7	109.1	92.8	66.4	52.2	51.7	50.3	31.5	38.4	73.7
Below Normal (13%)		86.1	74.8	88.3	111.8	100.5	82.2	68.8	68.9	62.0	38.4	57.7	116.0
Dry (24%)		100.7	103.4	113.1	136.5	108.7	91.2	82.3	76.5	60.4	49.6	89.5	113.8
Critical (15%)		136.3	146.4	162.4	164.8	140.1	126.2	117.4	106.1	92.6	85.5	102.5	126.5

No Action Alternative minus Second Basis of Comparison		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a													
10%		3.9	1.6	10.1	-6.1	-0.8	19.9	27.7	27.1	15.6	5.5	12.2	4.4
20%		-3.0	-11.1	-9.3	-10.9	-1.8	20.2	24.0	24.9	8.1	5.6	14.7	-0.9
30%		-12.1	-14.8	-22.0	-23.1	8.3	18.1	22.0	23.6	14.9	2.6	4.5	-2.3
40%		-9.5	-11.8	-32.1	-35.1	19.3	16.6	18.7	27.9	13.9	1.7	-1.0	-8.0
50%		-23.5	-26.5	-72.9	-37.3	16.4	10.0	16.4	15.8	13.6	1.1	3.8	-7.4
60%		-85.2	-82.0	-84.1	10.2	20.8	10.8	5.8	12.9	12.9	1.8	2.3	-9.0
70%		-83.1	-81.4	-79.4	10.0	17.0	9.4	1.5	8.8	11.8	2.2	1.1	-14.3
80%		-82.3	-75.1	-55.4	9.5	5.6	6.0	1.2	6.8	10.0	1.9	-0.2	-12.3
90%		-72.3	-50.8	-11.2	14.8	9.2	0.5	2.4	-2.2	1.1	1.0	-0.4	-12.0
Long Term													
Full Simulation Period ^b		-38.1	-35.7	-35.9	-8.0	9.3	12.2	13.0	14.6	11.2	2.5	4.5	-6.7
Water Year Types^c													
Wet (32%)		-43.3	-47.9	-39.2	6.3	12.3	3.0	2.0	4.9	5.0	0.2	1.4	-4.4
Above Normal (16%)		-27.7	-19.5	-26.3	-9.8	16.9	11.0	10.9	14.9	14.4	1.4	-0.5	-34.3
Below Normal (13%)		-44.7	-44.4	-46.8	-24.6	-9.4	6.0	10.9	20.1	25.0	4.7	-0.9	8.3
Dry (24%)		-44.2	-35.9	-42.6	-13.0	10.8	23.1	24.9	20.7	9.6	4.5	15.2	8.2
Critical (15%)		-22.1	-18.7	-18.1	-13.7	9.2	20.7	21.6	20.1	11.5	3.0	4.1	-3.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.18.5. Banks Pumping Plant, Monthly Chloride Concentration

Second Basis of Comparison

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	166.0	185.8	193.1	193.8	142.0	105.3	80.7	69.3	71.3	67.6	99.2	131.1
20%	159.4	159.2	176.8	179.0	123.6	83.0	68.8	63.8	63.0	48.1	73.6	125.4
30%	157.2	149.8	167.2	158.0	100.3	72.4	56.4	58.1	47.0	42.9	66.5	116.8
40%	150.0	140.9	156.1	148.6	83.3	65.2	50.9	45.0	42.4	40.1	61.4	110.6
50%	146.0	136.6	148.1	140.5	77.9	60.0	45.8	41.2	39.2	37.6	52.1	106.4
60%	142.6	130.8	140.7	84.4	67.2	53.2	41.7	36.8	36.6	33.9	42.4	103.6
70%	135.7	123.4	124.7	69.5	56.9	45.8	37.3	35.3	34.6	30.9	38.5	100.6
80%	129.3	113.8	93.0	62.1	50.5	40.1	31.6	31.2	31.8	28.6	35.4	89.1
90%	112.7	85.2	45.2	50.0	39.9	34.7	22.4	19.9	29.5	27.1	31.9	82.3
Long Term												
Full Simulation Period ^b	140.5	134.4	137.7	122.0	85.7	64.3	51.6	47.2	45.8	42.9	57.9	106.4
Water Year Types^c												
Wet (32%)	127.3	120.0	106.7	70.3	50.1	41.9	29.3	27.2	34.4	33.3	35.8	86.9
Above Normal (16%)	151.8	140.2	135.0	118.9	75.9	55.4	41.3	36.8	35.9	30.1	38.9	108.0
Below Normal (13%)	130.8	119.2	135.1	136.5	109.9	76.2	57.9	48.8	37.0	33.7	58.6	107.7
Dry (24%)	144.9	139.3	155.6	149.5	97.9	68.1	57.4	55.9	50.8	45.1	74.3	116.0
Critical (15%)	158.4	165.1	180.6	178.5	131.0	105.5	95.8	86.0	81.2	82.5	98.4	129.7

Alternative 3

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	172.3	185.8	196.2	192.0	136.6	116.0	103.4	91.5	63.5	70.8	113.3	139.8
20%	159.3	160.5	175.1	177.8	120.1	99.5	90.4	78.3	52.5	50.0	79.8	128.9
30%	151.8	147.4	164.1	165.5	110.5	87.9	74.2	61.9	44.8	43.2	67.8	118.4
40%	149.3	141.0	157.8	149.9	96.8	76.9	61.0	48.4	39.3	41.0	61.6	113.4
50%	145.0	133.7	149.3	139.1	89.8	63.3	50.3	43.1	35.7	39.1	54.6	108.5
60%	138.6	131.8	140.0	96.4	77.3	57.2	43.0	37.6	33.7	35.8	44.3	103.1
70%	133.0	126.7	125.1	82.5	67.9	49.2	36.9	33.8	31.4	31.4	37.4	100.1
80%	127.8	113.4	97.1	69.8	52.0	39.6	31.3	31.1	28.9	29.0	35.7	90.7
90%	112.8	97.7	46.3	60.0	39.6	35.4	25.0	21.0	27.2	27.0	29.9	77.2
Long Term												
Full Simulation Period ^b	139.6	136.6	138.9	126.3	89.1	71.8	59.3	51.7	43.3	44.1	60.3	107.3
Water Year Types^c												
Wet (32%)	125.9	121.7	110.3	81.3	54.4	41.7	29.8	27.5	30.4	32.9	35.6	83.9
Above Normal (16%)	154.7	146.8	138.6	129.7	87.2	58.7	42.9	36.7	32.5	30.2	38.6	109.6
Below Normal (13%)	130.6	117.6	135.3	142.5	102.2	77.3	62.7	56.0	40.6	38.5	61.9	120.5
Dry (24%)	141.3	142.1	157.8	153.2	104.9	86.6	74.6	62.1	44.6	47.9	82.5	115.6
Critical (15%)	158.5	166.4	173.2	160.3	128.1	121.7	112.4	99.3	83.3	82.1	98.9	129.7

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	6.3	0.0	3.1	-1.8	-5.5	10.7	22.6	22.2	-7.8	3.2	14.2	8.7
20%	-0.1	1.3	-1.8	-1.2	-3.5	16.5	21.6	14.5	-10.6	1.9	6.2	3.5
30%	-5.4	-2.4	-3.1	7.5	10.2	15.6	17.8	3.8	-2.2	0.3	1.4	1.7
40%	-0.7	0.1	1.7	1.3	13.5	11.7	10.2	3.4	-3.1	0.9	0.3	2.8
50%	-1.1	-2.9	1.2	-1.3	11.9	3.4	4.5	1.9	-3.6	1.5	2.5	2.1
60%	-4.0	1.0	-0.7	12.0	10.1	4.0	1.2	0.9	-2.9	1.9	1.9	-0.5
70%	-2.7	3.3	0.4	13.0	11.0	3.4	-0.5	-1.5	-3.1	0.5	-1.1	-0.5
80%	-1.5	-0.4	4.1	7.7	1.6	-0.5	-0.4	-0.1	-2.9	0.4	0.3	1.6
90%	0.1	12.5	1.1	10.0	-0.3	0.8	2.6	1.1	-2.3	-0.1	-2.0	-5.1
Long Term												
Full Simulation Period ^b	-0.9	2.2	1.2	4.3	3.4	7.5	7.7	4.5	-2.6	1.2	2.4	0.9
Water Year Types^c												
Wet (32%)	-1.4	1.7	3.6	11.0	4.3	-0.2	0.5	0.2	-4.1	-0.4	-0.2	-3.0
Above Normal (16%)	2.9	6.5	3.6	10.8	11.3	3.3	1.6	-0.1	-3.4	0.1	-0.3	1.5
Below Normal (13%)	-0.1	-1.7	0.2	6.1	-7.7	1.1	4.8	7.2	3.6	4.8	3.3	12.8
Dry (24%)	-3.6	2.8	2.2	3.7	7.0	18.5	17.2	6.2	-6.2	2.8	8.2	-0.5
Critical (15%)	0.1	1.4	-7.4	-18.2	-2.8	16.2	16.5	13.3	2.2	-0.4	0.5	-0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.18.6. Banks Pumping Plant, Monthly Chloride Concentration

Second Basis of Comparison

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	166.0	185.8	193.1	193.8	142.0	105.3	80.7	69.3	71.3	67.6	99.2	131.1
20%	159.4	159.2	176.8	179.0	123.6	83.0	68.8	63.8	63.0	48.1	73.6	125.4
30%	157.2	149.8	167.2	158.0	100.3	72.4	56.4	58.1	47.0	42.9	66.5	116.8
40%	150.0	140.9	156.1	148.6	83.3	65.2	50.9	45.0	42.4	40.1	61.4	110.6
50%	146.0	136.6	148.1	140.5	77.9	60.0	45.8	41.2	39.2	37.6	52.1	106.4
60%	142.6	130.8	140.7	84.4	67.2	53.2	41.7	36.8	36.6	33.9	42.4	103.6
70%	135.7	123.4	124.7	69.5	56.9	45.8	37.3	35.3	34.6	30.9	38.5	100.6
80%	129.3	113.8	93.0	62.1	50.5	40.1	31.6	31.2	31.8	28.6	35.4	89.1
90%	112.7	85.2	45.2	50.0	39.9	34.7	22.4	19.9	29.5	27.1	31.9	82.3
Long Term												
Full Simulation Period ^b	140.5	134.4	137.7	122.0	85.7	64.3	51.6	47.2	45.8	42.9	57.9	106.4
Water Year Types^c												
Wet (32%)	127.3	120.0	106.7	70.3	50.1	41.9	29.3	27.2	34.4	33.3	35.8	86.9
Above Normal (16%)	151.8	140.2	135.0	118.9	75.9	55.4	41.3	36.8	35.9	30.1	38.9	108.0
Below Normal (13%)	130.8	119.2	135.1	136.5	109.9	76.2	57.9	48.8	37.0	33.7	58.6	107.7
Dry (24%)	144.9	139.3	155.6	149.5	97.9	68.1	57.4	55.9	50.8	45.1	74.3	116.0
Critical (15%)	158.4	165.1	180.6	178.5	131.0	105.5	95.8	86.0	81.2	82.5	98.4	129.7

Alternative 5

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	168.9	188.6	203.7	188.5	141.3	125.1	118.5	109.3	103.1	80.2	114.0	135.3
20%	159.9	158.7	169.7	167.8	122.1	103.3	96.7	95.4	82.2	59.0	94.3	125.6
30%	147.0	135.9	146.0	134.8	108.8	90.5	82.6	83.1	74.9	47.5	77.1	118.7
40%	141.8	130.7	124.0	113.1	102.8	81.6	69.2	65.4	60.9	42.3	61.8	112.6
50%	128.1	113.1	75.4	102.3	94.5	70.0	62.9	55.6	53.5	39.5	56.0	100.0
60%	58.5	48.5	56.6	94.6	88.1	63.9	47.6	47.7	49.7	37.0	44.6	95.0
70%	52.9	41.1	45.4	79.4	74.0	55.9	39.1	43.4	46.7	33.3	39.6	89.2
80%	48.5	39.0	36.7	71.8	57.5	46.1	32.7	37.8	44.5	30.2	34.3	77.3
90%	40.8	34.6	34.4	65.1	49.0	35.8	24.9	17.9	30.8	28.6	30.0	69.1
Long Term												
Full Simulation Period ^b	103.7	99.6	101.8	114.3	95.3	76.9	66.5	64.0	62.7	46.7	64.3	101.4
Water Year Types^c												
Wet (32%)	84.5	73.5	69.0	76.6	62.6	45.1	31.4	31.1	39.2	33.5	37.1	82.3
Above Normal (16%)	127.7	122.8	106.9	108.6	92.8	66.4	51.7	49.0	50.1	31.7	38.3	73.5
Below Normal (13%)	85.8	75.4	88.4	111.7	100.3	82.0	68.5	64.8	64.1	39.4	57.9	117.8
Dry (24%)	102.4	103.4	112.1	138.6	109.8	91.6	85.6	82.7	72.6	52.7	96.0	118.3
Critical (15%)	137.7	146.7	162.3	164.2	140.4	127.7	124.6	119.3	109.9	88.4	104.2	129.8

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2.9	2.7	10.6	-5.3	-0.7	19.8	37.8	39.9	31.8	12.6	14.8	4.2
20%	0.6	-0.6	-7.1	-11.2	-1.4	20.2	27.9	31.6	19.1	10.9	20.6	0.2
30%	-10.2	-13.9	-21.2	-23.2	8.4	18.1	26.1	25.0	27.8	4.5	10.6	1.9
40%	-8.2	-10.2	-32.1	-35.5	19.5	16.4	18.4	20.5	18.5	2.2	0.4	1.9
50%	-17.9	-23.5	-72.8	-38.1	16.5	10.0	17.1	14.4	14.2	1.9	3.9	-6.4
60%	-84.1	-82.3	-84.1	10.2	20.8	10.7	5.8	10.9	13.0	3.1	2.2	-8.6
70%	-82.8	-82.4	-79.3	10.0	17.1	10.1	1.8	8.1	12.2	2.4	1.1	-11.4
80%	-80.8	-74.8	-56.3	9.7	7.0	6.0	1.0	6.6	12.7	1.6	-1.1	-11.8
90%	-71.9	-50.6	-10.9	15.1	9.2	1.1	2.5	-2.0	1.3	1.4	-1.9	-13.1
Long Term												
Full Simulation Period ^b	-36.8	-34.8	-36.0	-7.7	9.6	12.5	14.8	16.7	16.9	3.8	6.4	-5.0
Water Year Types^c												
Wet (32%)	-42.8	-46.5	-37.7	6.3	12.4	3.3	2.1	3.9	4.7	0.2	1.3	-4.7
Above Normal (16%)	-24.1	-17.4	-28.1	-10.3	16.9	11.0	10.4	12.2	14.2	1.6	-0.6	-34.6
Below Normal (13%)	-44.9	-43.8	-46.7	-24.8	-9.6	5.8	10.6	15.9	27.1	5.7	-0.7	10.1
Dry (24%)	-42.5	-35.9	-43.6	-11.0	12.0	23.5	28.2	26.8	21.7	7.6	21.7	2.3
Critical (15%)	-20.7	-18.4	-18.3	-14.3	9.4	22.2	28.8	33.3	28.7	5.9	5.8	0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1
2

B.19. Old River at Rock Slough Chloride Concentration

Table 6E.B.19.1. Old River at Rock Slough, Monthly Chloride Concentration

No Action Alternative												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	255.2	275.8	258.9	201.0	95.1	61.2	63.0	58.8	40.3	89.3	155.8	207.5
20%	233.0	212.0	226.9	165.4	84.7	47.7	54.8	52.8	31.5	58.8	135.7	191.7
30%	213.2	183.6	190.0	126.9	65.6	40.1	47.8	49.9	28.9	50.0	111.1	178.8
40%	196.7	168.5	120.7	104.2	59.5	36.1	44.8	46.3	28.1	44.7	91.2	164.3
50%	181.9	124.1	72.5	86.8	49.9	32.7	41.2	43.9	27.1	30.2	78.6	140.9
60%	32.8	37.2	50.1	72.7	43.2	29.4	39.9	41.1	26.4	26.1	66.1	123.3
70%	30.3	24.7	38.6	50.8	34.7	27.0	35.7	36.9	25.3	24.8	55.2	114.5
80%	29.1	23.0	28.6	39.1	31.5	24.2	30.5	29.7	23.9	23.4	50.0	96.0
90%	27.7	21.8	24.2	30.8	27.8	23.3	26.3	20.0	22.9	21.9	42.0	85.7
Long Term												
Full Simulation Period ^b	133.3	125.6	118.7	102.3	58.7	38.1	43.3	42.5	31.2	47.5	90.2	143.4
Water Year Types ^c												
Wet (32%)	95.1	80.5	60.7	51.3	42.8	31.9	33.0	34.4	24.6	23.4	49.2	103.3
Above Normal (16%)	177.3	159.9	119.0	86.0	48.5	30.3	46.3	49.3	26.2	25.3	57.1	89.6
Below Normal (13%)	93.9	87.2	104.5	103.1	56.8	34.9	50.3	51.2	29.1	41.4	85.5	181.0
Dry (24%)	134.8	134.2	143.2	137.1	65.1	39.7	44.2	39.8	28.3	66.0	127.9	172.5
Critical (15%)	202.0	207.0	215.9	171.7	94.8	59.9	54.2	49.3	58.0	98.4	156.7	205.6
Alternative 1												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	257.7	275.2	280.8	231.3	145.5	59.5	40.3	37.7	39.9	86.2	150.0	209.0
20%	236.7	236.6	245.5	201.4	99.0	48.8	33.3	31.4	31.1	50.6	113.7	195.6
30%	224.6	215.3	239.7	181.6	69.6	42.7	30.3	27.9	28.1	45.9	101.2	185.5
40%	218.2	199.1	229.5	165.4	56.6	31.1	27.0	26.4	26.3	37.9	91.5	173.3
50%	210.2	191.5	197.8	120.7	47.0	28.8	25.7	25.2	24.2	29.3	74.3	169.4
60%	204.9	184.6	178.5	86.1	37.0	26.5	25.0	24.5	23.1	26.1	65.1	164.3
70%	196.0	173.4	148.4	42.8	33.1	24.4	24.2	23.4	22.1	24.9	51.0	161.2
80%	187.2	140.7	98.8	33.8	29.6	23.1	23.0	22.5	21.5	23.1	45.0	145.0
90%	164.1	90.2	31.6	27.4	23.4	21.0	21.8	20.7	20.7	22.2	38.8	123.3
Long Term												
Full Simulation Period ^b	205.5	188.4	183.9	124.6	65.1	36.6	30.0	28.0	30.1	44.3	83.9	168.1
Water Year Types ^c												
Wet (32%)	182.9	169.9	126.1	53.6	37.4	32.4	27.8	22.4	23.0	23.2	44.5	134.4
Above Normal (16%)	228.2	193.7	177.4	115.3	46.0	27.6	25.7	23.4	22.0	24.8	56.0	169.5
Below Normal (13%)	186.4	164.8	187.7	154.4	94.3	38.7	29.6	26.9	24.2	40.9	85.3	170.7
Dry (24%)	211.0	195.1	219.0	163.6	77.1	34.0	27.9	29.1	27.9	53.2	110.8	181.9
Critical (15%)	238.4	233.2	254.5	196.0	99.3	58.1	43.2	44.0	62.9	99.0	153.2	213.8
Alternative 1 minus No Action Alternative												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	2.6	-0.6	21.9	30.3	50.4	-1.7	-22.7	-21.1	-0.4	-3.1	-5.8	1.6
20%	3.7	24.5	18.6	36.1	14.3	1.1	-21.5	-21.4	-0.4	-8.2	-21.9	3.9
30%	11.3	31.7	49.7	54.7	3.9	2.5	-17.4	-21.9	-0.8	-4.1	-9.8	6.8
40%	21.6	30.7	108.8	61.1	-2.9	-4.9	-17.8	-19.9	-1.8	-6.8	0.3	9.0
50%	28.3	67.4	125.3	33.9	-2.9	-3.8	-15.5	-18.7	-2.9	-0.9	-4.3	28.5
60%	172.2	147.4	128.5	13.5	-6.2	-2.8	-14.9	-16.6	-3.3	-0.1	-1.0	41.0
70%	165.7	148.7	109.8	-8.0	-1.5	-2.6	-11.6	-13.5	-3.2	0.1	-4.2	46.6
80%	158.1	117.7	70.2	-5.2	-1.9	-1.2	-7.4	-7.2	-2.3	-0.2	-5.0	49.0
90%	136.4	68.4	7.5	-3.4	-4.4	-2.3	-4.5	0.7	-2.2	0.3	-3.1	37.6
Long Term												
Full Simulation Period ^b	72.2	62.8	65.3	22.3	6.5	-1.4	-13.3	-14.6	-1.2	-3.2	-6.4	24.7
Water Year Types ^c												
Wet (32%)	87.8	89.3	65.4	2.2	-5.4	0.5	-5.2	-12.0	-1.6	-0.1	-4.7	31.1
Above Normal (16%)	50.8	33.8	58.4	29.4	-2.6	-2.7	-20.6	-25.9	-4.2	-0.4	-1.0	79.9
Below Normal (13%)	92.5	77.6	83.2	51.3	37.5	3.8	-20.7	-24.3	-4.9	-0.5	-0.1	-10.3
Dry (24%)	76.2	60.9	75.8	26.5	12.0	-5.7	-16.3	-10.6	-0.3	-12.7	-17.2	9.5
Critical (15%)	36.4	26.2	38.6	24.3	4.4	-1.8	-11.0	-5.4	4.9	0.6	-3.6	8.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.19.2. Old River at Rock Slough, Monthly Chloride Concentration

No Action Alternative		Monthly Chloride Concentration (mg/L)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	255.2	275.8	258.9	201.0	95.1	61.2	63.0	58.8	40.3	89.3	155.8	207.5	
20%	233.0	212.0	226.9	165.4	84.7	47.7	54.8	52.8	31.5	58.8	135.7	191.7	
30%	213.2	183.6	190.0	126.9	65.6	40.1	47.8	49.9	28.9	50.0	111.1	178.8	
40%	196.7	168.5	120.7	104.2	59.5	36.1	44.8	46.3	28.1	44.7	91.2	164.3	
50%	181.9	124.1	72.5	86.8	49.9	32.7	41.2	43.9	27.1	30.2	78.6	140.9	
60%	32.8	37.2	50.1	72.7	43.2	29.4	39.9	41.1	26.4	26.1	66.1	123.3	
70%	30.3	24.7	38.6	50.8	34.7	27.0	35.7	36.9	25.3	24.8	55.2	114.5	
80%	29.1	23.0	28.6	39.1	31.5	24.2	30.5	29.7	23.9	23.4	50.0	96.0	
90%	27.7	21.8	24.2	30.8	27.8	23.3	26.3	20.0	22.9	21.9	42.0	85.7	
Long Term													
Full Simulation Period ^b	133.3	125.6	118.7	102.3	58.7	38.1	43.3	42.5	31.2	47.5	90.2	143.4	
Water Year Types^c													
Wet (32%)	95.1	80.5	60.7	51.3	42.8	31.9	33.0	34.4	24.6	23.4	49.2	103.3	
Above Normal (16%)	177.3	159.9	119.0	86.0	48.5	30.3	46.3	49.3	26.2	25.3	57.1	89.6	
Below Normal (13%)	93.9	87.2	104.5	103.1	56.8	34.9	50.3	51.2	29.1	41.4	85.5	181.0	
Dry (24%)	134.8	134.2	143.2	137.1	65.1	39.7	44.2	39.8	28.3	66.0	127.9	172.5	
Critical (15%)	202.0	207.0	215.9	171.7	94.8	59.9	54.2	49.3	58.0	98.4	156.7	205.6	

Alternative 3		Monthly Chloride Concentration (mg/L)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	256.5	270.6	280.0	204.8	94.0	52.7	48.3	39.4	36.8	106.4	158.9	217.0	
20%	237.6	237.7	251.2	184.1	77.5	45.1	38.7	32.4	29.4	59.2	131.4	194.0	
30%	227.5	215.5	235.5	167.5	65.3	38.5	33.6	27.1	26.5	53.9	102.4	184.5	
40%	219.4	197.8	225.3	143.0	56.8	33.5	29.8	25.3	24.7	43.1	95.3	179.6	
50%	208.4	190.1	195.7	121.4	45.5	30.5	27.7	23.8	22.7	29.9	81.8	172.0	
60%	200.5	183.0	176.3	82.0	39.9	27.5	25.2	23.0	22.0	26.7	64.1	164.6	
70%	191.0	175.1	142.8	46.7	35.5	25.5	24.3	22.0	21.0	25.0	52.1	159.2	
80%	185.4	158.7	95.0	39.6	29.1	23.5	23.5	21.1	20.2	23.9	43.4	144.5	
90%	169.1	105.3	35.0	28.3	24.8	21.9	22.0	19.3	19.2	22.7	36.3	126.7	
Long Term													
Full Simulation Period ^b	205.6	192.5	180.7	114.9	55.8	36.0	31.7	27.4	28.6	48.5	87.1	168.2	
Water Year Types^c													
Wet (32%)	180.9	173.5	126.0	58.3	39.2	30.3	26.4	21.0	21.1	23.6	43.3	129.5	
Above Normal (16%)	234.8	204.3	175.4	109.7	44.4	27.4	26.4	22.5	21.1	25.7	56.0	171.2	
Below Normal (13%)	187.4	161.4	188.8	137.3	60.7	32.7	31.5	27.8	24.7	48.0	91.4	185.5	
Dry (24%)	208.6	202.1	218.7	150.0	62.1	37.3	32.7	28.1	26.4	65.0	121.1	179.5	
Critical (15%)	239.1	233.0	234.4	163.8	89.3	58.7	47.6	45.1	60.4	100.2	155.5	213.9	

Alternative 3 minus No Action Alternative		Monthly Chloride Concentration (mg/L)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	1.3	-5.2	21.1	3.8	-1.1	-8.4	-14.7	-19.4	-3.6	17.1	3.2	9.5	
20%	4.6	25.7	24.4	18.7	-7.2	-2.7	-16.1	-20.4	-2.0	0.4	-4.3	2.4	
30%	14.3	31.9	45.5	40.6	-0.3	-1.6	-14.2	-22.8	-2.3	3.9	-8.6	5.7	
40%	22.7	29.3	104.6	38.7	-2.7	-2.6	-15.0	-21.0	-3.4	-1.6	4.0	15.3	
50%	26.5	66.0	123.1	34.5	-4.4	-2.2	-13.5	-20.0	-4.5	-0.4	3.2	31.1	
60%	167.7	145.9	126.2	9.3	-3.4	-1.9	-14.7	-18.1	-4.4	0.6	-2.0	41.3	
70%	160.7	150.4	104.2	-4.0	0.8	-1.6	-11.4	-14.9	-4.3	0.2	-3.2	44.7	
80%	156.3	135.6	66.4	0.6	-2.4	-0.8	-7.0	-8.5	-3.7	0.5	-6.7	48.6	
90%	141.4	83.5	10.9	-2.5	-2.9	-1.4	-4.3	-0.7	-3.7	0.7	-5.7	41.0	
Long Term													
Full Simulation Period ^b	72.3	66.8	62.1	12.6	-2.8	-2.0	-11.5	-15.1	-2.6	1.1	-3.1	24.8	
Water Year Types^c													
Wet (32%)	85.8	93.0	65.3	7.0	-3.6	-1.6	-6.6	-13.4	-3.5	0.2	-5.9	26.1	
Above Normal (16%)	57.4	44.4	56.3	23.7	-4.1	-2.8	-19.9	-26.8	-5.1	0.5	-1.1	81.6	
Below Normal (13%)	93.5	74.2	84.3	34.3	3.9	-2.2	-18.8	-23.4	-4.4	6.6	6.0	4.5	
Dry (24%)	73.8	67.9	75.6	12.9	-3.0	-2.4	-11.5	-11.6	-1.9	-1.0	-6.8	7.0	
Critical (15%)	37.1	26.0	18.5	-7.9	-5.6	-1.2	-6.7	-4.3	2.4	1.8	-1.2	8.4	

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.19.3. Old River at Rock Slough, Monthly Chloride Concentration

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance^a												
10%	255.2	275.8	258.9	201.0	95.1	61.2	63.0	58.8	40.3	89.3	155.8	207.5
20%	233.0	212.0	226.9	165.4	84.7	47.7	54.8	52.8	31.5	58.8	135.7	191.7
30%	213.2	183.6	190.0	126.9	65.6	40.1	47.8	49.9	28.9	50.0	111.1	178.8
40%	196.7	168.5	120.7	104.2	59.5	36.1	44.8	46.3	28.1	44.7	91.2	164.3
50%	181.9	124.1	72.5	86.8	49.9	32.7	41.2	43.9	27.1	30.2	78.6	140.9
60%	32.8	37.2	50.1	72.7	43.2	29.4	39.9	41.1	26.4	26.1	66.1	123.3
70%	30.3	24.7	38.6	50.8	34.7	27.0	35.7	36.9	25.3	24.8	55.2	114.5
80%	29.1	23.0	28.6	39.1	31.5	24.2	30.5	29.7	23.9	23.4	50.0	96.0
90%	27.7	21.8	24.2	30.8	27.8	23.3	26.3	20.0	22.9	21.9	42.0	85.7
Long Term												
Full Simulation Period ^b	133.3	125.6	118.7	102.3	58.7	38.1	43.3	42.5	31.2	47.5	90.2	143.4
Water Year Types^c												
Wet (32%)	95.1	80.5	60.7	51.3	42.8	31.9	33.0	34.4	24.6	23.4	49.2	103.3
Above Normal (16%)	177.3	159.9	119.0	86.0	48.5	30.3	46.3	49.3	26.2	25.3	57.1	89.6
Below Normal (13%)	93.9	87.2	104.5	103.1	56.8	34.9	50.3	51.2	29.1	41.4	85.5	181.0
Dry (24%)	134.8	134.2	143.2	137.1	65.1	39.7	44.2	39.8	28.3	66.0	127.9	172.5
Critical (15%)	202.0	207.0	215.9	171.7	94.8	59.9	54.2	49.3	58.0	98.4	156.7	205.6

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 5												
Probability of Exceedance^a												
10%	265.2	274.3	257.6	214.2	95.4	61.1	82.8	87.5	49.7	93.2	159.7	208.8
20%	233.8	224.5	220.5	168.4	84.8	48.0	71.4	83.3	40.6	68.0	144.1	192.4
30%	216.1	187.1	191.2	127.9	67.2	39.7	65.3	77.5	33.7	52.5	115.6	185.5
40%	203.4	166.2	135.2	104.7	59.6	36.2	60.5	67.3	30.2	46.1	93.6	168.2
50%	178.1	127.0	67.3	87.5	49.7	32.7	53.1	61.3	28.6	29.9	79.1	144.5
60%	33.0	36.8	49.6	72.0	43.5	29.3	46.2	53.2	27.3	26.1	64.4	123.2
70%	30.2	24.5	39.1	48.5	34.6	27.0	41.5	48.6	26.0	24.9	56.2	114.4
80%	29.2	23.0	28.5	39.1	31.5	24.2	34.5	43.3	25.1	23.6	49.2	97.2
90%	28.1	21.8	24.2	30.8	27.8	23.3	26.6	20.0	23.8	21.8	41.9	84.4
Long Term												
Full Simulation Period ^b	134.6	126.0	118.6	103.2	59.7	38.4	54.8	59.9	34.0	48.4	92.8	145.7
Water Year Types^c												
Wet (32%)	95.4	83.3	62.5	51.3	43.3	32.1	33.2	35.7	25.0	23.4	49.2	102.5
Above Normal (16%)	181.7	158.1	116.3	85.4	48.6	30.3	47.6	53.3	27.1	25.4	56.7	89.2
Below Normal (13%)	93.6	88.2	104.3	102.9	56.5	34.7	58.5	67.1	32.7	42.7	85.8	183.6
Dry (24%)	136.5	132.9	142.6	140.4	66.0	39.9	67.7	75.5	35.1	71.5	137.0	179.0
Critical (15%)	202.7	206.9	215.7	173.2	99.8	62.1	84.6	86.9	60.3	94.2	159.2	210.4

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 5 minus No Action Alternative												
Probability of Exceedance^a												
10%	10.1	-1.5	-1.3	13.3	0.3	-0.1	19.8	28.7	9.3	3.9	4.0	1.3
20%	0.7	12.5	-6.4	3.1	0.2	0.3	16.6	30.5	9.2	9.2	8.4	0.7
30%	2.9	3.5	1.2	1.1	1.6	-0.4	17.6	27.6	4.9	2.5	4.6	6.7
40%	6.7	-2.2	14.5	0.5	0.2	0.1	15.7	21.0	2.0	1.5	2.4	3.9
50%	-3.8	2.9	-5.2	0.7	-0.2	0.0	11.9	17.4	1.5	-0.4	0.5	3.6
60%	0.3	-0.3	-0.4	-0.7	0.3	0.0	6.3	12.1	0.9	0.0	-1.7	-0.1
70%	-0.2	-0.1	0.5	-2.3	0.0	0.0	5.8	11.7	0.7	0.1	1.0	-0.1
80%	0.1	-0.1	0.0	0.0	0.0	0.0	4.0	13.7	1.2	0.3	-0.8	1.2
90%	0.4	0.0	0.0	0.0	0.0	0.0	0.3	0.0	1.0	-0.1	0.0	-1.4
Long Term												
Full Simulation Period ^b	1.3	0.4	-0.1	0.9	1.1	0.4	11.5	17.4	2.7	0.9	2.5	2.3
Water Year Types^c												
Wet (32%)	0.3	2.8	1.8	0.0	0.5	0.2	0.2	1.3	0.3	0.0	0.0	-0.9
Above Normal (16%)	4.4	-1.8	-2.7	-0.6	0.1	0.0	1.3	4.0	0.9	0.2	-0.4	-0.4
Below Normal (13%)	-0.3	1.0	-0.2	-0.2	-0.3	-0.2	8.2	15.9	3.5	1.3	0.3	2.6
Dry (24%)	1.7	-1.3	-0.5	3.3	0.9	0.2	23.5	35.7	6.9	5.5	9.0	6.5
Critical (15%)	0.7	-0.2	-0.3	1.5	4.9	2.2	30.3	37.5	2.3	-4.1	2.5	4.9

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.19.4. Old River at Rock Slough, Monthly Chloride Concentration

Second Basis of Comparison

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	257.7	275.2	280.8	231.3	145.5	59.5	40.3	37.7	39.9	86.2	150.0	209.0
20%	236.7	236.6	245.5	201.4	99.0	48.8	33.3	31.4	31.1	50.6	113.7	195.6
30%	224.6	215.3	239.7	181.6	69.6	42.7	30.3	27.9	28.1	45.9	101.2	185.5
40%	218.2	199.1	229.5	165.4	56.6	31.1	27.0	26.4	26.3	37.9	91.5	173.3
50%	210.2	191.5	197.8	120.7	47.0	28.8	25.7	25.2	24.2	29.3	74.3	169.4
60%	204.9	184.6	178.5	86.1	37.0	26.5	25.0	24.5	23.1	26.1	65.1	164.3
70%	196.0	173.4	148.4	42.8	33.1	24.4	24.2	23.4	22.1	24.9	51.0	161.2
80%	187.2	140.7	98.8	33.8	29.6	23.1	23.0	22.5	21.5	23.1	45.0	145.0
90%	164.1	90.2	31.6	27.4	23.4	21.0	21.8	20.7	20.7	22.2	38.8	123.3
Long Term												
Full Simulation Period ^b	205.5	188.4	183.9	124.6	65.1	36.6	30.0	28.0	30.1	44.3	83.9	168.1
Water Year Types^c												
Wet (32%)	182.9	169.9	126.1	53.6	37.4	32.4	27.8	22.4	23.0	23.2	44.5	134.4
Above Normal (16%)	228.2	193.7	177.4	115.3	46.0	27.6	25.7	23.4	22.0	24.8	56.0	169.5
Below Normal (13%)	186.4	164.8	187.7	154.4	94.3	38.7	29.6	26.9	24.2	40.9	85.3	170.7
Dry (24%)	211.0	195.1	219.0	163.6	77.1	34.0	27.9	29.1	27.9	53.2	110.8	181.9
Critical (15%)	238.4	233.2	254.5	196.0	99.3	58.1	43.2	44.0	62.9	99.0	153.2	213.8

No Action Alternative

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	255.2	275.8	258.9	201.0	95.1	61.2	63.0	58.8	40.3	89.3	155.8	207.5
20%	233.0	212.0	226.9	165.4	84.7	47.7	54.8	52.8	31.5	58.8	135.7	191.7
30%	213.2	183.6	190.0	126.9	65.6	40.1	47.8	49.9	28.9	50.0	111.1	178.8
40%	196.7	168.5	120.7	104.2	59.5	36.1	44.8	46.3	28.1	44.7	91.2	164.3
50%	181.9	124.1	72.5	86.8	49.9	32.7	41.2	43.9	27.1	30.2	78.6	140.9
60%	32.8	37.2	50.1	72.7	43.2	29.4	39.9	41.1	26.4	26.1	66.1	123.3
70%	30.3	24.7	38.6	50.8	34.7	27.0	35.7	36.9	25.3	24.8	55.2	114.5
80%	29.1	23.0	28.6	39.1	31.5	24.2	30.5	29.7	23.9	23.4	50.0	96.0
90%	27.7	21.8	24.2	30.8	27.8	23.3	26.3	20.0	22.9	21.9	42.0	85.7
Long Term												
Full Simulation Period ^b	133.3	125.6	118.7	102.3	58.7	38.1	43.3	42.5	31.2	47.5	90.2	143.4
Water Year Types^c												
Wet (32%)	95.1	80.5	60.7	51.3	42.8	31.9	33.0	34.4	24.6	23.4	49.2	103.3
Above Normal (16%)	177.3	159.9	119.0	86.0	48.5	30.3	46.3	49.3	26.2	25.3	57.1	89.6
Below Normal (13%)	93.9	87.2	104.5	103.1	56.8	34.9	50.3	51.2	29.1	41.4	85.5	181.0
Dry (24%)	134.8	134.2	143.2	137.1	65.1	39.7	44.2	39.8	28.3	66.0	127.9	172.5
Critical (15%)	202.0	207.0	215.9	171.7	94.8	59.9	54.2	49.3	58.0	98.4	156.7	205.6

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-2.6	0.6	-21.9	-30.3	-50.4	1.7	22.7	21.1	0.4	3.1	5.8	-1.6
20%	-3.7	-24.5	-18.6	-36.1	-14.3	-1.1	21.5	21.4	0.4	8.2	21.9	-3.9
30%	-11.3	-31.7	-49.7	-54.7	-3.9	-2.5	17.4	21.9	0.8	4.1	9.8	-6.8
40%	-21.6	-30.7	-108.8	-61.1	2.9	4.9	17.8	19.9	1.8	6.8	-0.3	-9.0
50%	-28.3	-67.4	-125.3	-33.9	2.9	3.8	15.5	18.7	2.9	0.9	4.3	-28.5
60%	-172.2	-147.4	-128.5	-13.5	6.2	2.8	14.9	16.6	3.3	0.1	1.0	-41.0
70%	-165.7	-148.7	-109.8	8.0	1.5	2.6	11.6	13.5	3.2	-0.1	4.2	-46.6
80%	-158.1	-117.7	-70.2	5.2	1.9	1.2	7.4	7.2	2.3	0.2	5.0	-49.0
90%	-136.4	-68.4	-7.5	3.4	4.4	2.3	4.5	-0.7	2.2	-0.3	3.1	-37.6
Long Term												
Full Simulation Period ^b	-72.2	-62.8	-65.3	-22.3	-6.5	1.4	13.3	14.6	1.2	3.2	6.4	-24.7
Water Year Types^c												
Wet (32%)	-87.8	-89.3	-65.4	-2.2	5.4	-0.5	5.2	12.0	1.6	0.1	4.7	-31.1
Above Normal (16%)	-50.8	-33.8	-58.4	-29.4	2.6	2.7	20.6	25.9	4.2	0.4	1.0	-79.9
Below Normal (13%)	-92.5	-77.6	-83.2	-51.3	-37.5	-3.8	20.7	24.3	4.9	0.5	0.1	10.3
Dry (24%)	-76.2	-60.9	-75.8	-26.5	-12.0	5.7	16.3	10.6	0.3	12.7	17.2	-9.5
Critical (15%)	-36.4	-26.2	-38.6	-24.3	-4.4	1.8	11.0	5.4	-4.9	-0.6	3.6	-8.3

^a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

^b Based on the 82-year simulation period.

^c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.19.5. Old River at Rock Slough, Monthly Chloride Concentration

Second Basis of Comparison

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	257.7	275.2	280.8	231.3	145.5	59.5	40.3	37.7	39.9	86.2	150.0	209.0
20%	236.7	236.6	245.5	201.4	99.0	48.8	33.3	31.4	31.1	50.6	113.7	195.6
30%	224.6	215.3	239.7	181.6	69.6	42.7	30.3	27.9	28.1	45.9	101.2	185.5
40%	218.2	199.1	229.5	165.4	56.6	31.1	27.0	26.4	26.3	37.9	91.5	173.3
50%	210.2	191.5	197.8	120.7	47.0	28.8	25.7	25.2	24.2	29.3	74.3	169.4
60%	204.9	184.6	178.5	86.1	37.0	26.5	25.0	24.5	23.1	26.1	65.1	164.3
70%	196.0	173.4	148.4	42.8	33.1	24.4	24.2	23.4	22.1	24.9	51.0	161.2
80%	187.2	140.7	98.8	33.8	29.6	23.1	23.0	22.5	21.5	23.1	45.0	145.0
90%	164.1	90.2	31.6	27.4	23.4	21.0	21.8	20.7	20.7	22.2	38.8	123.3
Long Term												
Full Simulation Period ^b	205.5	188.4	183.9	124.6	65.1	36.6	30.0	28.0	30.1	44.3	83.9	168.1
Water Year Types ^c												
Wet (32%)	182.9	169.9	126.1	53.6	37.4	32.4	27.8	22.4	23.0	23.2	44.5	134.4
Above Normal (16%)	228.2	193.7	177.4	115.3	46.0	27.6	25.7	23.4	22.0	24.8	56.0	169.5
Below Normal (13%)	186.4	164.8	187.7	154.4	94.3	38.7	29.6	26.9	24.2	40.9	85.3	170.7
Dry (24%)	211.0	195.1	219.0	163.6	77.1	34.0	27.9	29.1	27.9	53.2	110.8	181.9
Critical (15%)	238.4	233.2	254.5	196.0	99.3	58.1	43.2	44.0	62.9	99.0	153.2	213.8

Alternative 3

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	256.5	270.6	280.0	204.8	94.0	52.7	48.3	39.4	36.8	106.4	158.9	217.0
20%	237.6	237.7	251.2	184.1	77.5	45.1	38.7	32.4	29.4	59.2	131.4	194.0
30%	227.5	215.5	235.5	167.5	65.3	38.5	33.6	27.1	26.5	53.9	102.4	184.5
40%	219.4	197.8	225.3	143.0	56.8	33.5	29.8	25.3	24.7	43.1	95.3	179.6
50%	208.4	190.1	195.7	121.4	45.5	30.5	27.7	23.8	22.7	29.9	81.8	172.0
60%	200.5	183.0	176.3	82.0	39.9	27.5	25.2	23.0	22.0	26.7	64.1	164.6
70%	191.0	175.1	142.8	46.7	35.5	25.5	24.3	22.0	21.0	25.0	52.1	159.2
80%	185.4	158.7	95.0	39.6	29.1	23.5	23.5	21.1	20.2	23.9	43.4	144.5
90%	169.1	105.3	35.0	28.3	24.8	21.9	22.0	19.3	19.2	22.7	36.3	126.7
Long Term												
Full Simulation Period ^b	205.6	192.5	180.7	114.9	55.8	36.0	31.7	27.4	28.6	48.5	87.1	168.2
Water Year Types ^c												
Wet (32%)	180.9	173.5	126.0	58.3	39.2	30.3	26.4	21.0	21.1	23.6	43.3	129.5
Above Normal (16%)	234.8	204.3	175.4	109.7	44.4	27.4	26.4	22.5	21.1	25.7	56.0	171.2
Below Normal (13%)	187.4	161.4	188.8	137.3	60.7	32.7	31.5	27.8	24.7	48.0	91.4	185.5
Dry (24%)	208.6	202.1	218.7	150.0	62.1	37.3	32.7	28.1	26.4	65.0	121.1	179.5
Critical (15%)	239.1	233.0	234.4	163.8	89.3	58.7	47.6	45.1	60.4	100.2	155.5	213.9

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-1.2	-4.6	-0.8	-26.5	-51.5	-6.7	8.0	1.7	-3.2	20.2	8.9	8.0
20%	0.9	1.1	5.8	-17.4	-21.5	-3.7	5.4	1.0	-1.6	8.5	17.7	-1.6
30%	2.9	0.2	-4.2	-14.1	-4.2	-4.2	3.2	-0.9	-1.6	8.0	1.2	-1.0
40%	1.1	-1.3	-4.1	-22.4	0.2	2.4	2.8	-1.1	-1.6	5.2	3.7	6.2
50%	-1.8	-1.4	-2.2	0.6	-1.6	1.7	2.1	-1.3	-1.5	0.6	7.5	2.6
60%	-4.5	-1.6	-2.3	-4.1	2.9	1.0	0.2	-1.5	-1.1	0.7	-1.0	0.3
70%	-5.0	1.7	-5.6	4.0	2.4	1.0	0.1	-1.3	-1.1	0.2	1.0	-1.9
80%	-1.8	18.0	-3.8	5.8	-0.5	0.4	0.4	-1.4	-1.3	0.8	-1.7	-0.4
90%	5.0	15.1	3.4	0.9	1.4	0.9	0.2	-1.4	-1.5	0.5	-2.5	3.4
Long Term												
Full Simulation Period ^b	0.1	4.1	-3.2	-9.7	-9.3	-0.6	1.7	-0.5	-1.4	4.2	3.3	0.1
Water Year Types ^c												
Wet (32%)	-2.0	3.7	-0.1	4.8	1.8	-2.1	-1.4	-1.4	-1.9	0.3	-1.3	-5.0
Above Normal (16%)	6.6	10.6	-2.1	-5.7	-1.6	-0.2	0.7	-0.9	-0.9	0.9	-0.1	1.7
Below Normal (13%)	1.0	-3.4	1.1	-17.0	-33.6	-6.0	1.9	0.9	0.5	7.1	6.1	14.8
Dry (24%)	-2.4	7.0	-0.3	-13.7	-15.0	3.3	4.8	-1.0	-1.6	11.7	10.3	-2.5
Critical (15%)	0.7	-0.2	-20.1	-32.2	-10.0	0.5	4.4	1.1	-2.5	1.2	2.3	0.1

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.19.6. Old River at Rock Slough, Monthly Chloride Concentration

Second Basis of Comparison		Monthly Chloride Concentration (mg/L)											
		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
	10%	257.7	275.2	280.8	231.3	145.5	59.5	40.3	37.7	39.9	86.2	150.0	209.0
	20%	236.7	236.6	245.5	201.4	99.0	48.8	33.3	31.4	31.1	50.6	113.7	195.6
	30%	224.6	215.3	239.7	181.6	69.6	42.7	30.3	27.9	28.1	45.9	101.2	185.5
	40%	218.2	199.1	229.5	165.4	56.6	31.1	27.0	26.4	26.3	37.9	91.5	173.3
	50%	210.2	191.5	197.8	120.7	47.0	28.8	25.7	25.2	24.2	29.3	74.3	169.4
	60%	204.9	184.6	178.5	86.1	37.0	26.5	25.0	24.5	23.1	26.1	65.1	164.3
	70%	196.0	173.4	148.4	42.8	33.1	24.4	24.2	23.4	22.1	24.9	51.0	161.2
	80%	187.2	140.7	98.8	33.8	29.6	23.1	23.0	22.5	21.5	23.1	45.0	145.0
	90%	164.1	90.2	31.6	27.4	23.4	21.0	21.8	20.7	20.7	22.2	38.8	123.3
Long Term													
	Full Simulation Period ^b	205.5	188.4	183.9	124.6	65.1	36.6	30.0	28.0	30.1	44.3	83.9	168.1
Water Year Types ^c													
	Wet (32%)	182.9	169.9	126.1	53.6	37.4	32.4	27.8	22.4	23.0	23.2	44.5	134.4
	Above Normal (16%)	228.2	193.7	177.4	115.3	46.0	27.6	25.7	23.4	22.0	24.8	56.0	169.5
	Below Normal (13%)	186.4	164.8	187.7	154.4	94.3	38.7	29.6	26.9	24.2	40.9	85.3	170.7
	Dry (24%)	211.0	195.1	219.0	163.6	77.1	34.0	27.9	29.1	27.9	53.2	110.8	181.9
	Critical (15%)	238.4	233.2	254.5	196.0	99.3	58.1	43.2	44.0	62.9	99.0	153.2	213.8

Alternative 5

Alternative 5		Monthly Chloride Concentration (mg/L)											
		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
	10%	265.2	274.3	257.6	214.2	95.4	61.1	82.8	87.5	49.7	93.2	159.7	208.8
	20%	233.8	224.5	220.5	168.4	84.8	48.0	71.4	83.3	40.6	68.0	144.1	192.4
	30%	216.1	187.1	191.2	127.9	67.2	39.7	65.3	77.5	33.7	52.5	115.6	185.5
	40%	203.4	166.2	135.2	104.7	59.6	36.2	60.5	67.3	30.2	46.1	93.6	168.2
	50%	178.1	127.0	67.3	87.5	49.7	32.7	53.1	61.3	28.6	29.9	79.1	144.5
	60%	33.0	36.8	49.6	72.0	43.5	29.3	46.2	53.2	27.3	26.1	64.4	123.2
	70%	30.2	24.5	39.1	48.5	34.6	27.0	41.5	48.6	26.0	24.9	56.2	114.4
	80%	29.2	23.0	28.5	39.1	31.5	24.2	34.5	43.3	25.1	23.6	49.2	97.2
	90%	28.1	21.8	24.2	30.8	27.8	23.3	26.6	20.0	23.8	21.8	41.9	84.4
Long Term													
	Full Simulation Period ^b	134.6	126.0	118.6	103.2	59.7	38.4	54.8	59.9	34.0	48.4	92.8	145.7
Water Year Types ^c													
	Wet (32%)	95.4	83.3	62.5	51.3	43.3	32.1	33.2	35.7	25.0	23.4	49.2	102.5
	Above Normal (16%)	181.7	158.1	116.3	85.4	48.6	30.3	47.6	53.3	27.1	25.4	56.7	89.2
	Below Normal (13%)	93.6	88.2	104.3	102.9	56.5	34.7	58.5	67.1	32.7	42.7	85.8	183.6
	Dry (24%)	136.5	132.9	142.6	140.4	66.0	39.9	67.7	75.5	35.1	71.5	137.0	179.0
	Critical (15%)	202.7	206.9	215.7	173.2	99.8	62.1	84.6	86.9	60.3	94.2	159.2	210.4

Alternative 5 minus Second Basis of Comparison

Alternative 5 minus Second Basis of Comparison		Monthly Chloride Concentration (mg/L)												
		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a														
	10%		7.5	-0.9	-23.2	-17.1	-50.1	1.6	42.5	49.8	9.7	7.0	9.8	-0.3
	20%		-2.9	-12.1	-25.0	-33.0	-14.2	-0.8	38.2	52.0	9.6	17.4	30.3	-3.2
	30%		-8.5	-28.2	-48.5	-53.7	-2.4	-2.9	35.0	49.6	5.6	6.6	14.4	0.0
	40%		-14.9	-32.9	-94.3	-60.6	3.0	5.0	33.5	40.9	3.9	8.3	2.1	-5.1
	50%		-32.1	-64.5	-130.5	-33.2	2.6	3.8	27.5	36.1	4.4	0.6	4.8	-25.0
	60%		-171.9	-147.8	-128.9	-14.2	6.5	2.8	21.2	28.8	4.2	0.1	-0.7	-41.1
	70%		-165.8	-148.9	-109.3	5.7	1.5	2.6	17.3	25.2	3.9	0.0	5.1	-46.8
	80%		-158.0	-117.7	-70.2	5.2	1.9	1.2	11.4	20.8	3.5	0.5	4.2	-47.8
	90%		-136.0	-68.4	-7.4	3.4	4.4	2.3	4.8	-0.7	3.2	-0.4	3.1	-39.0
Long Term														
	Full Simulation Period ^b		-71.0	-62.4	-65.4	-21.3	-5.4	1.8	24.8	31.9	3.9	4.1	8.9	-22.4
Water Year Types ^c														
	Wet (32%)		-87.5	-86.5	-63.6	-2.2	5.9	-0.4	5.4	13.3	2.0	0.1	4.6	-32.0
	Above Normal (16%)		-46.4	-35.6	-61.1	-29.9	2.6	2.7	21.9	30.0	5.0	0.6	0.6	-80.4
	Below Normal (13%)		-92.8	-76.6	-83.4	-51.5	-37.8	-4.0	28.9	40.1	8.4	1.8	0.4	12.9
	Dry (24%)		-74.5	-62.2	-76.4	-23.2	-11.1	5.9	39.8	46.3	7.2	18.3	26.2	-3.0
	Critical (15%)		-35.7	-26.3	-38.8	-22.8	0.5	3.9	41.4	42.9	-2.7	-4.8	6.1	-3.4

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1 **B.20. Contra Costa Water District Old River Intake Chloride**
2 **Concentration**

Table 6E.B.20.1. Contra Costa Water District Old River Intake, Monthly Chloride Concentration

No Action Alternative												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	205.4	227.2	231.3	199.2	122.5	99.6	98.5	86.0	66.3	73.7	130.0	166.2
20%	190.2	178.6	194.1	168.6	108.0	78.6	81.3	78.1	53.6	55.0	110.4	155.8
30%	175.1	155.7	163.5	140.2	94.4	70.5	70.9	74.2	44.9	46.6	91.4	141.4
40%	164.9	143.7	126.2	112.9	82.4	60.4	64.7	66.3	42.1	42.5	74.7	130.4
50%	153.1	116.5	73.0	103.8	77.1	54.0	55.0	61.9	39.0	32.5	66.2	115.3
60%	45.9	44.0	54.4	88.4	70.2	49.2	42.3	57.0	38.4	29.6	54.2	108.1
70%	42.1	33.8	39.7	78.0	55.0	44.4	38.2	51.6	36.5	28.5	46.1	99.0
80%	39.5	29.1	32.9	59.8	51.0	38.7	29.8	37.9	32.0	27.6	42.4	85.0
90%	35.8	27.8	29.9	49.6	40.9	29.8	22.0	17.7	27.9	26.7	36.4	79.4
Long Term												
Full Simulation Period ^b	115.6	109.6	108.3	112.5	82.1	61.7	57.1	59.1	43.9	44.9	74.4	119.4
Water Year Types^c												
Wet (32%)	88.7	75.5	63.8	72.3	57.0	42.4	28.9	36.5	32.7	28.0	42.4	92.5
Above Normal (16%)	147.3	137.1	112.7	104.5	76.5	49.3	47.6	58.0	37.9	28.2	46.7	81.2
Below Normal (13%)	88.7	79.3	94.4	109.0	84.5	61.1	66.2	74.2	46.3	39.1	70.3	145.9
Dry (24%)	115.3	116.7	126.0	138.6	92.1	70.9	71.7	66.1	44.0	56.3	106.1	139.9
Critical (15%)	164.6	170.0	183.4	168.2	123.8	101.9	95.5	83.5	72.3	85.9	124.9	160.8
Alternative 1												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	206.8	225.9	237.8	210.5	145.7	90.8	66.0	60.1	63.3	71.7	119.6	165.3
20%	194.0	193.4	209.4	189.8	115.4	71.4	57.5	53.7	49.5	48.4	91.4	157.9
30%	186.6	179.1	201.8	170.3	89.6	59.6	45.4	46.3	37.7	43.6	83.3	148.6
40%	181.0	166.8	188.0	159.2	70.2	49.1	40.7	36.3	34.2	37.3	75.2	139.7
50%	175.0	159.0	171.0	136.8	63.0	44.6	35.9	32.2	30.5	32.9	62.1	134.8
60%	171.1	154.3	154.1	92.9	54.9	40.2	31.9	30.4	28.9	29.5	52.5	130.9
70%	161.9	147.0	137.5	60.0	51.4	33.7	30.0	29.1	27.8	27.7	43.5	128.0
80%	156.7	127.3	89.9	49.2	39.9	29.6	29.0	28.5	26.8	27.0	39.8	115.0
90%	138.4	88.9	41.6	38.3	30.8	27.4	24.3	26.5	25.4	26.1	35.5	101.1
Long Term												
Full Simulation Period ^b	169.3	158.1	159.5	125.0	77.3	52.1	42.9	39.7	38.0	42.6	69.4	134.4
Water Year Types^c												
Wet (32%)	152.1	142.6	116.9	66.3	47.6	40.8	29.4	26.3	28.8	27.9	39.7	108.7
Above Normal (16%)	186.0	163.7	155.2	120.5	62.2	40.7	34.2	30.1	28.6	27.4	46.7	136.3
Below Normal (13%)	155.7	139.5	159.8	145.1	104.3	56.7	44.8	38.8	29.7	37.2	71.0	136.8
Dry (24%)	173.9	163.5	185.2	156.6	88.9	51.0	46.3	46.6	39.9	47.8	90.6	145.8
Critical (15%)	193.6	193.3	213.1	186.2	114.0	86.8	74.3	68.6	72.9	87.1	121.8	166.8
Alternative 1 minus No Action Alternative												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1.4	-1.3	6.5	11.2	23.2	-8.9	-32.5	-25.9	-3.0	-2.0	-10.4	-0.9
20%	3.8	14.7	15.3	21.2	7.4	-7.2	-23.8	-24.4	-4.2	-6.6	-19.0	2.1
30%	11.5	23.3	38.3	30.1	-4.9	-10.9	-25.4	-27.9	-7.2	-3.0	-8.0	7.2
40%	16.0	23.0	61.8	46.3	-12.2	-11.3	-24.0	-30.0	-7.9	-5.3	0.5	9.3
50%	21.8	42.6	98.0	33.0	-14.2	-9.4	-19.2	-29.7	-8.4	0.4	-4.1	19.5
60%	125.1	110.3	99.7	4.4	-15.4	-9.0	-10.4	-26.5	-9.5	-0.2	-1.7	22.8
70%	119.8	113.2	97.8	-18.1	-3.6	-10.8	-8.2	-22.5	-8.7	-0.8	-2.6	29.0
80%	117.2	98.2	57.1	-10.6	-11.1	-9.1	-0.9	-9.3	-5.3	-0.7	-2.5	30.0
90%	102.6	61.1	11.7	-11.3	-10.1	-2.4	2.3	8.8	-2.5	-0.6	-0.9	21.7
Long Term												
Full Simulation Period ^b	53.8	48.4	51.1	12.5	-4.8	-9.5	-14.1	-19.3	-5.9	-2.3	-5.0	15.0
Water Year Types^c												
Wet (32%)	63.4	67.1	53.1	-6.0	-9.4	-1.7	0.5	-10.2	-4.0	-0.2	-2.8	16.2
Above Normal (16%)	38.7	26.6	42.5	16.0	-14.3	-8.6	-13.4	-27.9	-9.3	-0.8	0.0	55.1
Below Normal (13%)	67.0	60.2	65.4	36.1	19.7	-4.4	-21.5	-35.4	-16.6	-1.9	0.7	-9.1
Dry (24%)	58.6	46.8	59.2	18.0	-3.2	-19.8	-25.4	-19.5	-4.1	-8.4	-15.5	5.9
Critical (15%)	29.0	23.3	29.7	18.0	-9.8	-15.1	-21.2	-14.9	0.6	1.2	-3.1	6.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
b Based on the 82-year simulation period.
c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.20.2. Contra Costa Water District Old River Intake, Monthly Chloride Concentration

No Action Alternative												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	205.4	227.2	231.3	199.2	122.5	99.6	98.5	86.0	66.3	73.7	130.0	166.2
20%	190.2	178.6	194.1	168.6	108.0	78.6	81.3	78.1	53.6	55.0	110.4	155.8
30%	175.1	155.7	163.5	140.2	94.4	70.5	70.9	74.2	44.9	46.6	91.4	141.4
40%	164.9	143.7	126.2	112.9	82.4	60.4	64.7	66.3	42.1	42.5	74.7	130.4
50%	153.1	116.5	73.0	103.8	77.1	54.0	55.0	61.9	39.0	32.5	66.2	115.3
60%	45.9	44.0	54.4	88.4	70.2	49.2	42.3	57.0	38.4	29.6	54.2	108.1
70%	42.1	33.8	39.7	78.0	55.0	44.4	38.2	51.6	36.5	28.5	46.1	99.0
80%	39.5	29.1	32.9	59.8	51.0	38.7	29.8	37.9	32.0	27.6	42.4	85.0
90%	35.8	27.8	29.9	49.6	40.9	29.8	22.0	17.7	27.9	26.7	36.4	79.4
Long Term												
Full Simulation Period ^b	115.6	109.6	108.3	112.5	82.1	61.7	57.1	59.1	43.9	44.9	74.4	119.4
Water Year Types^c												
Wet (32%)	88.7	75.5	63.8	72.3	57.0	42.4	28.9	36.5	32.7	28.0	42.4	92.5
Above Normal (16%)	147.3	137.1	112.7	104.5	76.5	49.3	47.6	58.0	37.9	28.2	46.7	81.2
Below Normal (13%)	88.7	79.3	94.4	109.0	84.5	61.1	66.2	74.2	46.3	39.1	70.3	145.9
Dry (24%)	115.3	116.7	126.0	138.6	92.1	70.9	71.7	66.1	44.0	56.3	106.1	139.9
Critical (15%)	164.6	170.0	183.4	168.2	123.8	101.9	95.5	83.5	72.3	85.9	124.9	160.8
Alternative 3												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	207.2	221.7	232.4	198.0	123.0	95.6	85.7	74.1	59.7	85.0	130.1	172.6
20%	195.8	196.1	212.7	183.9	107.2	74.7	68.6	57.0	39.3	52.5	104.8	157.7
30%	183.9	178.1	196.5	159.5	94.4	65.2	60.3	43.0	34.7	48.5	83.2	148.1
40%	179.8	163.8	185.8	148.3	84.8	58.9	52.6	37.0	30.9	41.2	77.0	142.8
50%	173.5	158.4	169.9	137.7	73.4	51.2	41.2	31.4	28.6	32.9	66.9	137.5
60%	166.2	153.5	157.6	95.6	64.6	44.1	35.5	29.5	27.2	29.5	53.1	131.5
70%	161.8	149.3	138.7	71.9	55.0	37.1	32.4	27.9	26.1	28.3	44.3	127.6
80%	155.2	134.0	92.9	62.6	46.3	32.2	30.1	26.7	25.5	27.2	39.3	114.2
90%	138.2	101.6	43.0	40.3	35.1	27.4	27.4	24.7	24.2	26.1	32.7	99.6
Long Term												
Full Simulation Period ^b	168.8	161.0	158.3	124.4	77.7	57.4	50.0	41.1	35.0	45.2	72.2	134.8
Water Year Types^c												
Wet (32%)	150.4	145.3	118.1	76.2	51.6	38.7	30.5	25.2	26.0	28.0	38.9	104.8
Above Normal (16%)	190.3	171.9	156.5	127.5	70.8	42.9	34.2	29.3	26.9	27.9	46.4	137.9
Below Normal (13%)	155.8	137.0	160.5	141.4	88.2	55.8	52.7	43.4	31.7	42.9	75.3	150.5
Dry (24%)	171.0	168.5	186.2	153.4	88.7	67.0	61.0	46.9	33.9	55.4	99.9	144.4
Critical (15%)	193.4	192.9	198.6	161.5	113.6	98.8	88.4	76.3	68.4	86.3	123.6	166.5
Alternative 3 minus No Action Alternative												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	1.8	-5.5	1.1	-1.2	0.5	-4.0	-12.8	-11.9	-6.6	11.3	0.2	6.3
20%	5.6	17.5	18.6	15.3	-0.8	-3.9	-12.6	-21.1	-14.3	-2.5	-5.6	2.0
30%	8.8	22.4	32.9	19.3	-0.1	-5.3	-10.6	-31.2	-10.2	1.9	-8.2	6.6
40%	14.8	20.0	59.5	35.4	2.4	-1.6	-12.1	-29.4	-11.2	-1.3	2.3	12.4
50%	20.4	42.0	96.9	33.9	-3.8	-2.8	-13.8	-30.5	-10.4	0.4	0.8	22.2
60%	120.2	109.4	103.1	7.2	-5.6	-5.1	-6.8	-27.4	-11.2	-0.1	-1.1	23.4
70%	119.7	115.5	99.0	-6.1	0.0	-7.4	-5.8	-23.7	-10.4	-0.2	-1.8	28.6
80%	115.7	104.9	60.0	2.8	-4.7	-6.5	0.3	-11.2	-6.5	-0.4	-3.1	29.2
90%	102.4	73.8	13.0	-9.3	-5.8	-2.4	5.4	7.0	-3.7	-0.6	-3.7	20.3
Long Term												
Full Simulation Period ^b	53.2	51.4	49.9	11.8	-4.4	-4.3	-7.1	-18.0	-8.9	0.3	-2.2	15.4
Water Year Types^c												
Wet (32%)	61.7	69.8	54.2	3.9	-5.3	-3.7	1.5	-11.3	-6.8	-0.1	-3.5	12.3
Above Normal (16%)	43.0	34.7	43.8	23.0	-5.7	-6.4	-13.4	-28.6	-11.0	-0.3	-0.3	56.7
Below Normal (13%)	67.0	57.7	66.1	32.4	3.6	-5.3	-13.6	-30.8	-14.6	3.8	5.0	4.5
Dry (24%)	55.7	51.8	60.3	14.7	-3.4	-3.9	-10.7	-19.2	-10.0	-0.8	-6.1	4.5
Critical (15%)	28.8	23.0	15.2	-6.8	-10.1	-3.1	-7.1	-7.2	-3.9	0.4	-1.3	5.7

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.20.3. Contra Costa Water District Old River Intake, Monthly Chloride Concentration

No Action Alternative												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	205.4	227.2	231.3	199.2	122.5	99.6	98.5	86.0	66.3	73.7	130.0	166.2
20%	190.2	178.6	194.1	168.6	108.0	78.6	81.3	78.1	53.6	55.0	110.4	155.8
30%	175.1	155.7	163.5	140.2	94.4	70.5	70.9	74.2	44.9	46.6	91.4	141.4
40%	164.9	143.7	126.2	112.9	82.4	60.4	64.7	66.3	42.1	42.5	74.7	130.4
50%	153.1	116.5	73.0	103.8	77.1	54.0	55.0	61.9	39.0	32.5	66.2	115.3
60%	45.9	44.0	54.4	88.4	70.2	49.2	42.3	57.0	38.4	29.6	54.2	108.1
70%	42.1	33.8	39.7	78.0	55.0	44.4	38.2	51.6	36.5	28.5	46.1	99.0
80%	39.5	29.1	32.9	59.8	51.0	38.7	29.8	37.9	32.0	27.6	42.4	85.0
90%	35.8	27.8	29.9	49.6	40.9	29.8	22.0	17.7	27.9	26.7	36.4	79.4
Long Term												
Full Simulation Period ^b	115.6	109.6	108.3	112.5	82.1	61.7	57.1	59.1	43.9	44.9	74.4	119.4
Water Year Types^c												
Wet (32%)	88.7	75.5	63.8	72.3	57.0	42.4	28.9	36.5	32.7	28.0	42.4	92.5
Above Normal (16%)	147.3	137.1	112.7	104.5	76.5	49.3	47.6	58.0	37.9	28.2	46.7	81.2
Below Normal (13%)	88.7	79.3	94.4	109.0	84.5	61.1	66.2	74.2	46.3	39.1	70.3	145.9
Dry (24%)	115.3	116.7	126.0	138.6	92.1	70.9	71.7	66.1	44.0	56.3	106.1	139.9
Critical (15%)	164.6	170.0	183.4	168.2	123.8	101.9	95.5	83.5	72.3	85.9	124.9	160.8

Alternative 5												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	210.0	226.3	228.4	200.6	122.6	98.9	108.2	104.6	85.3	77.2	129.8	167.4
20%	193.1	185.6	190.2	172.6	108.2	79.3	98.2	101.8	61.6	57.1	117.5	157.9
30%	178.2	159.2	163.7	142.1	91.4	70.6	81.0	89.0	55.6	49.7	97.3	145.5
40%	168.4	141.4	129.0	112.8	82.6	59.8	66.0	74.9	47.5	44.0	75.9	136.9
50%	152.0	119.5	71.5	103.8	77.1	53.9	56.9	62.1	42.9	32.7	66.4	117.5
60%	46.8	43.5	57.4	88.1	70.5	49.4	42.2	54.3	39.2	29.6	53.2	109.4
70%	42.2	32.2	39.4	78.0	58.8	44.4	38.3	51.2	37.9	28.7	46.7	101.3
80%	39.3	29.3	32.9	59.8	50.6	38.7	29.2	37.9	34.6	27.5	42.7	87.3
90%	35.7	27.9	29.9	49.7	40.6	29.9	22.2	17.7	27.9	26.8	35.3	76.2
Long Term												
Full Simulation Period ^b	116.8	110.1	108.4	113.1	82.8	62.0	61.6	66.1	49.8	45.8	76.7	121.3
Water Year Types^c												
Wet (32%)	89.1	77.4	66.0	72.4	57.6	42.4	29.0	34.7	33.1	28.1	42.4	91.9
Above Normal (16%)	151.2	136.7	110.4	103.8	76.5	49.3	46.8	54.4	39.3	28.3	46.5	80.8
Below Normal (13%)	88.5	80.0	94.4	108.8	83.9	60.7	63.3	73.8	51.9	40.2	70.6	148.1
Dry (24%)	116.8	116.0	125.2	141.3	93.0	71.1	82.3	86.7	55.9	60.5	113.7	145.3
Critical (15%)	165.5	170.0	183.2	168.2	125.8	103.9	112.0	105.7	85.3	83.4	127.5	164.2

Alternative 5 minus No Action Alternative												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	4.7	-0.9	-3.0	1.3	0.1	-0.7	9.6	18.6	19.0	3.5	-0.2	1.1
20%	2.9	7.0	-3.9	4.1	0.2	0.7	17.0	23.7	8.0	2.1	7.1	2.1
30%	3.2	3.5	0.1	1.8	-3.0	0.1	10.2	14.8	10.6	3.1	5.9	4.1
40%	3.5	-2.4	2.7	0.0	0.3	-0.7	1.3	8.6	5.4	1.5	1.2	6.5
50%	-1.1	3.0	-1.4	0.0	-0.1	0.0	1.9	0.2	3.9	0.2	0.2	2.2
60%	0.9	-0.5	2.9	-0.4	0.3	0.2	-0.2	-2.7	0.8	0.0	-0.9	1.3
70%	0.2	-1.6	-0.3	0.0	3.8	0.0	0.1	-0.4	1.5	0.1	0.6	2.3
80%	-0.1	0.2	0.0	0.1	-0.4	0.0	-0.6	0.0	2.5	-0.1	0.3	2.3
90%	-0.1	0.1	0.0	0.1	-0.2	0.1	0.1	0.0	0.0	0.1	-1.1	-3.2
Long Term												
Full Simulation Period ^b	1.2	0.5	0.1	0.6	0.7	0.3	4.5	7.1	5.9	0.9	2.2	1.9
Water Year Types^c												
Wet (32%)	0.4	1.9	2.2	0.1	0.7	0.0	0.1	-1.8	0.4	0.0	-0.1	-0.6
Above Normal (16%)	3.9	-0.4	-2.3	-0.7	0.0	0.0	-0.8	-3.5	1.3	0.1	-0.2	-0.3
Below Normal (13%)	-0.2	0.7	-0.1	-0.2	-0.6	-0.4	-2.9	-0.4	5.6	1.1	0.2	2.2
Dry (24%)	1.5	-0.7	-0.8	2.7	1.0	0.2	10.6	20.6	11.9	4.2	7.6	5.4
Critical (15%)	0.9	0.0	-0.2	-0.1	2.0	2.0	16.5	22.2	13.0	-2.4	2.6	3.4

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.20.4. Contra Costa Water District Old River Intake, Monthly Chloride Concentration

Second Basis of Comparison

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	206.8	225.9	237.8	210.5	145.7	90.8	66.0	60.1	63.3	71.7	119.6	165.3
20%	194.0	193.4	209.4	189.8	115.4	71.4	57.5	53.7	49.5	48.4	91.4	157.9
30%	186.6	179.1	201.8	170.3	89.6	59.6	45.4	46.3	37.7	43.6	83.3	148.6
40%	181.0	166.8	188.0	159.2	70.2	49.1	40.7	36.3	34.2	37.3	75.2	139.7
50%	175.0	159.0	171.0	136.8	63.0	44.6	35.9	32.2	30.5	32.9	62.1	134.8
60%	171.1	154.3	154.1	92.9	54.9	40.2	31.9	30.4	28.9	29.5	52.5	130.9
70%	161.9	147.0	137.5	60.0	51.4	33.7	30.0	29.1	27.8	27.7	43.5	128.0
80%	156.7	127.3	89.9	49.2	39.9	29.6	29.0	28.5	26.8	27.0	39.8	115.0
90%	138.4	88.9	41.6	38.3	30.8	27.4	24.3	26.5	25.4	26.1	35.5	101.1
Long Term												
Full Simulation Period ^b	169.3	158.1	159.5	125.0	77.3	52.1	42.9	39.7	38.0	42.6	69.4	134.4
Water Year Types ^c												
Wet (32%)	152.1	142.6	116.9	66.3	47.6	40.8	29.4	26.3	28.8	27.9	39.7	108.7
Above Normal (16%)	186.0	163.7	155.2	120.5	62.2	40.7	34.2	30.1	28.6	27.4	46.7	136.3
Below Normal (13%)	155.7	139.5	159.8	145.1	104.3	56.7	44.8	38.8	29.7	37.2	71.0	136.8
Dry (24%)	173.9	163.5	185.2	156.6	88.9	51.0	46.3	46.6	39.9	47.8	90.6	145.8
Critical (15%)	193.6	193.3	213.1	186.2	114.0	86.8	74.3	68.6	72.9	87.1	121.8	166.8

No Action Alternative

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	205.4	227.2	231.3	199.2	122.5	99.6	98.5	86.0	66.3	73.7	130.0	166.2
20%	190.2	178.6	194.1	168.6	108.0	78.6	81.3	78.1	53.6	55.0	110.4	155.8
30%	175.1	155.7	163.5	140.2	94.4	70.5	70.9	74.2	44.9	46.6	91.4	141.4
40%	164.9	143.7	126.2	112.9	82.4	60.4	64.7	66.3	42.1	42.5	74.7	130.4
50%	153.1	116.5	73.0	103.8	77.1	54.0	55.0	61.9	39.0	32.5	66.2	115.3
60%	45.9	44.0	54.4	88.4	70.2	49.2	42.3	57.0	38.4	29.6	54.2	108.1
70%	42.1	33.8	39.7	78.0	55.0	44.4	38.2	51.6	36.5	28.5	46.1	99.0
80%	39.5	29.1	32.9	59.8	51.0	38.7	29.8	37.9	32.0	27.6	42.4	85.0
90%	35.8	27.8	29.9	49.6	40.9	29.8	22.0	17.7	27.9	26.7	36.4	79.4
Long Term												
Full Simulation Period ^b	115.6	109.6	108.3	112.5	82.1	61.7	57.1	59.1	43.9	44.9	74.4	119.4
Water Year Types ^c												
Wet (32%)	88.7	75.5	63.8	72.3	57.0	42.4	28.9	36.5	32.7	28.0	42.4	92.5
Above Normal (16%)	147.3	137.1	112.7	104.5	76.5	49.3	47.6	58.0	37.9	28.2	46.7	81.2
Below Normal (13%)	88.7	79.3	94.4	109.0	84.5	61.1	66.2	74.2	46.3	39.1	70.3	145.9
Dry (24%)	115.3	116.7	126.0	138.6	92.1	70.9	71.7	66.1	44.0	56.3	106.1	139.9
Critical (15%)	164.6	170.0	183.4	168.2	123.8	101.9	95.5	83.5	72.3	85.9	124.9	160.8

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-1.4	1.3	-6.5	-11.2	-23.2	8.9	32.5	25.9	3.0	2.0	10.4	0.9
20%	-3.8	-14.7	-15.3	-21.2	-7.4	7.2	23.8	24.4	4.2	6.6	19.0	-2.1
30%	-11.5	-23.3	-38.3	-30.1	4.9	10.9	25.4	27.9	7.2	3.0	8.0	-7.2
40%	-16.0	-23.0	-61.8	-46.3	12.2	11.3	24.0	30.0	7.9	5.3	-0.5	-9.3
50%	-21.8	-42.6	-98.0	-33.0	14.2	9.4	19.2	29.7	8.4	-0.4	4.1	-19.5
60%	-125.1	-110.3	-99.7	-4.4	15.4	9.0	10.4	26.5	9.5	0.2	1.7	-22.8
70%	-119.8	-113.2	-97.8	18.1	3.6	10.8	8.2	22.5	8.7	0.8	2.6	-29.0
80%	-117.2	-98.2	-57.1	10.6	11.1	9.1	0.9	9.3	5.3	0.7	2.5	-30.0
90%	-102.6	-61.1	-11.7	11.3	10.1	2.4	-2.3	-8.8	2.5	0.6	0.9	-21.7
Long Term												
Full Simulation Period ^b	-53.8	-48.4	-51.1	-12.5	4.8	9.5	14.1	19.3	5.9	2.3	5.0	-15.0
Water Year Types ^c												
Wet (32%)	-63.4	-67.1	-53.1	6.0	9.4	1.7	-0.5	10.2	4.0	0.2	2.8	-16.2
Above Normal (16%)	-38.7	-26.6	-42.5	-16.0	14.3	8.6	13.4	27.9	9.3	0.8	0.0	-55.1
Below Normal (13%)	-67.0	-60.2	-65.4	-36.1	-19.7	4.4	21.5	35.4	16.6	1.9	-0.7	9.1
Dry (24%)	-58.6	-46.8	-59.2	-18.0	3.2	19.8	25.4	19.5	4.1	8.4	15.5	-5.9
Critical (15%)	-29.0	-23.3	-29.7	-18.0	9.8	15.1	21.2	14.9	-0.6	-1.2	3.1	-6.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.20.5. Contra Costa Water District Old River Intake, Monthly Chloride Concentration

Second Basis of Comparison		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		206.8	225.9	237.8	210.5	145.7	90.8	66.0	60.1	63.3	71.7	119.6	165.3
20%		194.0	193.4	209.4	189.8	115.4	71.4	57.5	53.7	49.5	48.4	91.4	157.9
30%		186.6	179.1	201.8	170.3	89.6	59.6	45.4	46.3	37.7	43.6	83.3	148.6
40%		181.0	166.8	188.0	159.2	70.2	49.1	40.7	36.3	34.2	37.3	75.2	139.7
50%		175.0	159.0	171.0	136.8	63.0	44.6	35.9	32.2	30.5	32.9	62.1	134.8
60%		171.1	154.3	154.1	92.9	54.9	40.2	31.9	30.4	28.9	29.5	52.5	130.9
70%		161.9	147.0	137.5	60.0	51.4	33.7	30.0	29.1	27.8	27.7	43.5	128.0
80%		156.7	127.3	89.9	49.2	39.9	29.6	29.0	28.5	26.8	27.0	39.8	115.0
90%		138.4	88.9	41.6	38.3	30.8	27.4	24.3	26.5	25.4	26.1	35.5	101.1
Long Term													
Full Simulation Period ^b		169.3	158.1	159.5	125.0	77.3	52.1	42.9	39.7	38.0	42.6	69.4	134.4
Water Year Types ^c													
Wet (32%)		152.1	142.6	116.9	66.3	47.6	40.8	29.4	26.3	28.8	27.9	39.7	108.7
Above Normal (16%)		186.0	163.7	155.2	120.5	62.2	40.7	34.2	30.1	28.6	27.4	46.7	136.3
Below Normal (13%)		155.7	139.5	159.8	145.1	104.3	56.7	44.8	38.8	29.7	37.2	71.0	136.8
Dry (24%)		173.9	163.5	185.2	156.6	88.9	51.0	46.3	46.6	39.9	47.8	90.6	145.8
Critical (15%)		193.6	193.3	213.1	186.2	114.0	86.8	74.3	68.6	72.9	87.1	121.8	166.8

Alternative 3

Alternative 3		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		207.2	221.7	232.4	198.0	123.0	95.6	85.7	74.1	59.7	85.0	130.1	172.6
20%		195.8	196.1	212.7	183.9	107.2	74.7	68.6	57.0	39.3	52.5	104.8	157.7
30%		183.9	178.1	196.5	159.5	94.4	65.2	60.3	43.0	34.7	48.5	83.2	148.1
40%		179.8	163.8	185.8	148.3	84.8	58.9	52.6	37.0	30.9	41.2	77.0	142.8
50%		173.5	158.4	169.9	137.7	73.4	51.2	41.2	31.4	28.6	32.9	66.9	137.5
60%		166.2	153.5	157.6	95.6	64.6	44.1	35.5	29.5	27.2	29.5	53.1	131.5
70%		161.8	149.3	138.7	71.9	55.0	37.1	32.4	27.9	26.1	28.3	44.3	127.6
80%		155.2	134.0	92.9	62.6	46.3	32.2	30.1	26.7	25.5	27.2	39.3	114.2
90%		138.2	101.6	43.0	40.3	35.1	27.4	27.4	24.7	24.2	26.1	32.7	99.6
Long Term													
Full Simulation Period ^b		168.8	161.0	158.3	124.4	77.7	57.4	50.0	41.1	35.0	45.2	72.2	134.8
Water Year Types ^c													
Wet (32%)		150.4	145.3	118.1	76.2	51.6	38.7	30.5	25.2	26.0	28.0	38.9	104.8
Above Normal (16%)		190.3	171.9	156.5	127.5	70.8	42.9	34.2	29.3	26.9	27.9	46.4	137.9
Below Normal (13%)		155.8	137.0	160.5	141.4	88.2	55.8	52.7	43.4	31.7	42.9	75.3	150.5
Dry (24%)		171.0	168.5	186.2	153.4	88.7	67.0	61.0	46.9	33.9	55.4	99.9	144.4
Critical (15%)		193.4	192.9	198.6	161.5	113.6	98.8	88.4	76.3	68.4	86.3	123.6	166.5

Alternative 3 minus Second Basis of Comparison

Alternative 3 minus Second Basis of Comparison		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		0.4	-4.2	-5.4	-12.5	-22.6	4.9	19.7	14.0	-3.6	13.4	10.5	7.3
20%		1.8	2.8	3.3	-5.9	-8.2	3.3	11.2	3.3	-10.1	4.0	13.3	-0.1
30%		-2.7	-0.9	-5.4	-10.8	4.8	5.6	14.8	-3.3	-3.0	4.9	-0.2	-0.5
40%		-1.2	-3.0	-2.3	-10.9	14.6	9.8	11.9	0.7	-3.3	3.9	1.7	3.0
50%		-1.5	-0.6	-1.1	0.9	10.4	6.6	5.3	-0.8	-2.0	0.0	4.8	2.7
60%		-4.9	-0.9	3.4	2.7	9.7	3.9	3.6	-0.9	-1.8	0.0	0.6	0.5
70%		-0.1	2.3	1.2	12.0	3.6	3.4	2.4	-1.1	-1.7	0.6	0.8	-0.3
80%		-1.4	6.7	2.9	13.4	6.4	2.6	1.2	-1.8	-1.2	0.3	-0.5	-0.8
90%		-0.2	12.7	1.4	2.0	4.3	0.0	3.1	-1.8	-1.2	0.0	-2.8	-1.4
Long Term													
Full Simulation Period ^b		-0.6	3.0	-1.2	-0.7	0.4	5.2	7.0	1.3	-3.0	2.6	2.8	0.4
Water Year Types ^c													
Wet (32%)		-1.7	2.7	1.2	9.9	4.1	-2.0	1.1	-1.1	-2.8	0.1	-0.8	-3.9
Above Normal (16%)		4.3	8.1	1.3	7.0	8.5	2.2	0.0	-0.7	-1.7	0.5	-0.3	1.6
Below Normal (13%)		0.1	-2.5	0.7	-3.7	-16.1	-0.9	7.9	4.6	2.0	5.7	4.2	13.6
Dry (24%)		-2.9	5.0	1.0	-3.2	-0.2	15.9	14.7	0.3	-6.0	7.6	9.4	-1.4
Critical (15%)		-0.2	-0.3	-14.5	-24.8	-0.4	12.0	14.0	7.7	-4.4	-0.8	1.8	-0.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.20.6. Contra Costa Water District Old River Intake, Monthly Chloride Concentration

Second Basis of Comparison

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	206.8	225.9	237.8	210.5	145.7	90.8	66.0	60.1	63.3	71.7	119.6	165.3
20%	194.0	193.4	209.4	189.8	115.4	71.4	57.5	53.7	49.5	48.4	91.4	157.9
30%	186.6	179.1	201.8	170.3	89.6	59.6	45.4	46.3	37.7	43.6	83.3	148.6
40%	181.0	166.8	188.0	159.2	70.2	49.1	40.7	36.3	34.2	37.3	75.2	139.7
50%	175.0	159.0	171.0	136.8	63.0	44.6	35.9	32.2	30.5	32.9	62.1	134.8
60%	171.1	154.3	154.1	92.9	54.9	40.2	31.9	30.4	28.9	29.5	52.5	130.9
70%	161.9	147.0	137.5	60.0	51.4	33.7	30.0	29.1	27.8	27.7	43.5	128.0
80%	156.7	127.3	89.9	49.2	39.9	29.6	29.0	28.5	26.8	27.0	39.8	115.0
90%	138.4	88.9	41.6	38.3	30.8	27.4	24.3	26.5	25.4	26.1	35.5	101.1
Long Term												
Full Simulation Period ^b	169.3	158.1	159.5	125.0	77.3	52.1	42.9	39.7	38.0	42.6	69.4	134.4
Water Year Types ^c												
Wet (32%)	152.1	142.6	116.9	66.3	47.6	40.8	29.4	26.3	28.8	27.9	39.7	108.7
Above Normal (16%)	186.0	163.7	155.2	120.5	62.2	40.7	34.2	30.1	28.6	27.4	46.7	136.3
Below Normal (13%)	155.7	139.5	159.8	145.1	104.3	56.7	44.8	38.8	29.7	37.2	71.0	136.8
Dry (24%)	173.9	163.5	185.2	156.6	88.9	51.0	46.3	46.6	39.9	47.8	90.6	145.8
Critical (15%)	193.6	193.3	213.1	186.2	114.0	86.8	74.3	68.6	72.9	87.1	121.8	166.8

Alternative 5

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	210.0	226.3	228.4	200.6	122.6	98.9	108.2	104.6	85.3	77.2	129.8	167.4
20%	193.1	185.6	190.2	172.6	108.2	79.3	98.2	101.8	61.6	57.1	117.5	157.9
30%	178.2	159.2	163.7	142.1	91.4	70.6	81.0	89.0	55.6	49.7	97.3	145.5
40%	168.4	141.4	129.0	112.8	82.6	59.8	66.0	74.9	47.5	44.0	75.9	136.9
50%	152.0	119.5	71.5	103.8	77.1	53.9	56.9	62.1	42.9	32.7	66.4	117.5
60%	46.8	43.5	57.4	88.1	70.5	49.4	42.2	54.3	39.2	29.6	53.2	109.4
70%	42.2	32.2	39.4	78.0	58.8	44.4	38.3	51.2	37.9	28.7	46.7	101.3
80%	39.3	29.3	32.9	59.8	50.6	38.7	29.2	37.9	34.6	27.5	42.7	87.3
90%	35.7	27.9	29.9	49.7	40.6	29.9	22.2	17.7	27.9	26.8	35.3	76.2
Long Term												
Full Simulation Period ^b	116.8	110.1	108.4	113.1	82.8	62.0	61.6	66.1	49.8	45.8	76.7	121.3
Water Year Types ^c												
Wet (32%)	89.1	77.4	66.0	72.4	57.6	42.4	29.0	34.7	33.1	28.1	42.4	91.9
Above Normal (16%)	151.2	136.7	110.4	103.8	76.5	49.3	46.8	54.4	39.3	28.3	46.5	80.8
Below Normal (13%)	88.5	80.0	94.4	108.8	83.9	60.7	63.3	73.8	51.9	40.2	70.6	148.1
Dry (24%)	116.8	116.0	125.2	141.3	93.0	71.1	82.3	86.7	55.9	60.5	113.7	145.3
Critical (15%)	165.5	170.0	183.2	168.2	125.8	103.9	112.0	105.7	85.3	83.4	127.5	164.2

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.2	0.4	-9.4	-9.9	-23.1	8.1	42.1	44.5	22.0	5.5	10.2	2.1
20%	-0.9	-7.7	-19.2	-17.1	-7.2	7.9	40.8	48.1	12.2	8.6	26.0	0.0
30%	-8.3	-19.8	-38.1	-28.3	1.9	11.0	35.6	42.6	17.8	6.1	14.0	-3.1
40%	-12.5	-25.4	-59.0	-46.3	12.5	10.7	25.3	38.6	13.3	6.7	0.7	-2.8
50%	-22.9	-39.5	-99.4	-33.1	14.1	9.4	21.1	29.9	12.3	-0.2	4.3	-17.3
60%	-124.3	-110.8	-96.8	-4.8	15.7	9.2	10.2	23.8	10.2	0.1	0.8	-21.5
70%	-119.6	-114.8	-98.1	18.1	7.4	10.7	8.3	22.1	10.1	1.0	3.2	-26.7
80%	-117.3	-98.0	-57.1	10.7	10.7	9.1	0.3	9.3	7.8	0.6	2.9	-27.7
90%	-102.7	-61.0	-11.7	11.4	9.8	2.5	-2.1	-8.8	2.5	0.7	-0.2	-24.9
Long Term												
Full Simulation Period ^b	-52.5	-47.9	-51.0	-12.0	5.5	9.8	18.6	26.4	11.8	3.2	7.2	-13.1
Water Year Types ^c												
Wet (32%)	-63.0	-65.2	-50.9	6.0	10.1	1.6	-0.4	8.4	4.3	0.2	2.7	-16.8
Above Normal (16%)	-34.8	-27.0	-44.8	-16.7	14.3	8.6	12.5	24.3	10.7	0.9	-0.2	-55.5
Below Normal (13%)	-67.2	-59.5	-65.4	-36.3	-20.4	4.0	18.6	35.0	22.2	3.0	-0.5	11.3
Dry (24%)	-57.1	-47.6	-60.0	-15.3	4.2	20.1	36.0	40.1	16.0	12.7	23.2	-0.5
Critical (15%)	-28.1	-23.3	-29.9	-18.1	11.8	17.1	37.6	37.1	12.4	-3.7	5.7	-2.5

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1 **B.21. Contra Costa Water District Victoria Canal Intake**
2 **Chloride Concentration**

Table 6E.B.21.1. Contra Costa Victoria Canal Intake, Monthly Chloride Concentration

No Action Alternative		Monthly Chloride Concentration (mg/L)											
		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		113.4	124.0	146.2	160.4	141.4	117.2	113.6	88.1	71.9	56.9	76.0	91.4
20%		102.8	103.3	122.2	141.7	120.6	111.5	98.9	82.9	63.0	49.5	63.4	83.6
30%		96.4	93.5	108.5	120.8	111.3	98.7	89.8	79.2	56.6	44.5	58.7	80.1
40%		91.4	87.7	95.6	110.7	104.9	93.5	80.5	75.7	54.3	38.5	45.1	73.7
50%		84.6	73.4	67.3	100.4	99.6	85.1	69.9	61.4	53.2	35.7	39.2	70.5
60%		58.9	55.0	55.7	93.3	94.5	75.4	45.7	56.0	51.4	32.9	36.1	68.2
70%		56.5	51.8	48.6	86.2	87.1	63.9	37.3	49.3	48.9	30.9	33.4	63.7
80%		50.7	49.2	40.6	81.1	71.9	49.1	28.9	37.2	45.9	28.9	28.8	54.2
90%		44.8	45.3	33.5	69.8	53.8	37.6	21.8	17.2	38.0	27.0	26.9	49.3
Long Term													
Full Simulation Period ^b		77.5	77.0	82.4	107.2	98.3	82.2	65.3	60.9	53.9	40.1	47.5	70.2
Water Year Types ^c													
Wet (32%)		67.1	62.4	62.3	85.3	71.1	50.4	29.5	35.3	43.7	39.0	31.6	60.8
Above Normal (16%)		88.0	89.4	87.1	106.6	99.3	75.1	52.4	57.0	52.1	32.8	30.1	51.2
Below Normal (13%)		69.7	64.7	71.8	102.7	105.2	93.2	77.7	74.6	57.0	30.8	39.5	74.3
Dry (24%)		76.9	78.9	87.1	119.0	109.3	99.3	88.9	72.8	55.0	36.9	64.6	77.5
Critical (15%)		96.9	103.6	122.4	139.8	131.5	119.7	106.0	88.1	73.5	64.3	80.0	95.6

Alternative 1

Alternative 1		Monthly Chloride Concentration (mg/L)											
		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		118.3	126.7	133.5	151.5	124.0	104.0	94.8	80.9	75.4	53.7	69.0	95.4
20%		107.2	101.7	119.5	136.5	112.8	86.0	79.7	75.2	61.0	48.1	54.8	83.9
30%		100.3	99.0	114.1	127.2	97.1	83.3	68.8	70.2	53.5	43.7	49.3	77.5
40%		97.6	93.6	107.5	116.9	89.3	74.2	63.4	57.4	48.8	39.3	44.7	71.7
50%		93.5	88.3	102.3	109.8	80.7	67.5	58.4	49.5	45.5	35.3	40.4	69.4
60%		89.9	84.9	99.4	83.1	69.6	61.3	51.1	45.3	42.4	31.2	35.6	67.0
70%		86.4	77.4	89.2	74.8	65.5	53.6	44.4	41.2	39.6	28.6	33.5	63.0
80%		81.2	71.3	67.8	69.1	57.1	47.1	37.0	37.0	38.3	27.9	29.6	61.1
90%		66.4	63.8	44.0	54.3	47.9	39.2	27.1	22.9	31.8	26.2	28.0	51.5
Long Term													
Full Simulation Period ^b		92.6	89.4	97.5	103.6	83.9	69.0	58.2	53.3	49.3	39.6	45.1	70.5
Water Year Types ^c													
Wet (32%)		82.6	76.9	78.5	72.6	57.8	47.9	33.6	31.2	39.8	38.4	31.8	54.6
Above Normal (16%)		101.0	95.9	96.5	104.1	79.1	62.5	51.2	45.0	42.9	31.7	31.2	67.5
Below Normal (13%)		82.8	77.2	93.2	109.8	103.9	82.6	67.8	57.9	41.1	28.2	41.5	69.5
Dry (24%)		95.3	92.4	106.9	117.8	92.0	74.3	69.3	66.3	53.3	36.1	53.9	77.4
Critical (15%)		109.5	115.4	128.3	141.1	113.9	100.7	91.9	84.2	77.7	66.6	77.8	97.5

Alternative 1 minus No Action Alternative

Alternative 1 minus No Action Alternative		Monthly Chloride Concentration (mg/L)											
		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		4.8	2.7	-12.7	-8.9	-17.4	-13.2	-18.8	-7.2	3.5	-3.2	-7.0	4.0
20%		4.3	-1.6	-2.7	-5.1	-7.9	-25.6	-19.1	-7.7	-2.0	-1.4	-8.7	0.3
30%		3.9	5.5	5.5	6.3	-14.2	-15.4	-21.0	-9.0	-3.0	-0.8	-9.4	-2.6
40%		6.3	5.9	12.0	6.2	-15.6	-19.3	-17.1	-18.3	-5.5	0.8	-0.4	-1.9
50%		8.9	14.9	35.0	9.4	-18.8	-17.5	-11.5	-11.9	-7.7	-0.5	1.2	-1.1
60%		31.0	29.9	43.6	-10.2	-25.0	-14.1	5.3	-10.6	-8.9	-1.7	-0.5	-1.2
70%		30.0	25.6	40.6	-11.4	-21.6	-10.3	7.1	-8.1	-9.4	-2.3	0.1	-0.7
80%		30.4	22.1	27.2	-12.0	-14.8	-2.0	8.1	-0.2	-7.6	-1.0	0.8	6.9
90%		21.6	18.5	10.4	-15.5	-5.9	1.6	5.3	5.7	-6.2	-0.9	1.1	2.2
Long Term													
Full Simulation Period ^b		15.0	12.3	15.2	-3.6	-14.4	-13.1	-7.0	-7.6	-4.6	-0.6	-2.4	0.2
Water Year Types ^c													
Wet (32%)		15.4	14.5	16.2	-12.7	-13.3	-2.6	4.2	-4.1	-3.9	-0.6	0.2	-6.2
Above Normal (16%)		13.0	6.5	9.3	-2.6	-20.2	-12.7	-1.3	-12.0	-9.2	-1.2	1.0	16.3
Below Normal (13%)		13.1	12.5	21.4	7.1	-1.3	-10.7	-9.9	-16.6	-15.9	-2.6	2.0	-4.8
Dry (24%)		18.4	13.5	19.8	-1.3	-17.3	-25.0	-19.6	-6.5	-1.6	-0.8	-10.7	-0.1
Critical (15%)		12.6	11.8	5.9	1.2	-17.6	-19.0	-14.1	-3.9	4.2	2.3	-2.1	1.9

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.21.2. Contra Costa Victoria Canal Intake, Monthly Chloride Concentration

No Action Alternative												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	113.4	124.0	146.2	160.4	141.4	117.2	113.6	88.1	71.9	56.9	76.0	91.4
20%	102.8	103.3	122.2	141.7	120.6	111.5	98.9	82.9	63.0	49.5	63.4	83.6
30%	96.4	93.5	108.5	120.8	111.3	98.7	89.8	79.2	56.6	44.5	58.7	80.1
40%	91.4	87.7	95.6	110.7	104.9	93.5	80.5	75.7	54.3	38.5	45.1	73.7
50%	84.6	73.4	67.3	100.4	99.6	85.1	69.9	61.4	53.2	35.7	39.2	70.5
60%	58.9	55.0	55.7	93.3	94.5	75.4	45.7	56.0	51.4	32.9	36.1	68.2
70%	56.5	51.8	48.6	86.2	87.1	63.9	37.3	49.3	48.9	30.9	33.4	63.7
80%	50.7	49.2	40.6	81.1	71.9	49.1	28.9	37.2	45.9	28.9	28.8	54.2
90%	44.8	45.3	33.5	69.8	53.8	37.6	21.8	17.2	38.0	27.0	26.9	49.3
Long Term												
Full Simulation Period ^b	77.5	77.0	82.4	107.2	98.3	82.2	65.3	60.9	53.9	40.1	47.5	70.2
Water Year Types ^c												
Wet (32%)	67.1	62.4	62.3	85.3	71.1	50.4	29.5	35.3	43.7	39.0	31.6	60.8
Above Normal (16%)	88.0	89.4	87.1	106.6	99.3	75.1	52.4	57.0	52.1	32.8	30.1	51.2
Below Normal (13%)	69.7	64.7	71.8	102.7	105.2	93.2	77.7	74.6	57.0	30.8	39.5	74.3
Dry (24%)	76.9	78.9	87.1	119.0	109.3	99.3	88.9	72.8	55.0	36.9	64.6	77.5
Critical (15%)	96.9	103.6	122.4	139.8	131.5	119.7	106.0	88.1	73.5	64.3	80.0	95.6
Alternative 3												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	117.1	125.1	131.6	152.6	127.9	117.2	105.3	82.1	56.7	55.8	77.3	89.3
20%	107.1	104.1	119.2	140.0	116.2	106.7	93.2	71.6	50.9	50.7	60.3	85.3
30%	101.8	98.0	115.6	133.8	110.1	96.0	83.1	60.8	48.0	44.5	54.1	79.6
40%	97.1	93.8	108.9	123.7	103.9	89.6	73.5	47.2	43.8	36.1	46.2	76.0
50%	93.8	88.4	103.8	115.7	95.1	77.1	61.8	44.8	41.2	33.5	39.4	71.3
60%	88.7	84.0	97.6	96.4	84.9	67.6	51.5	40.8	38.3	31.0	36.7	68.2
70%	85.6	76.6	89.7	86.9	76.2	60.4	44.5	37.4	35.1	29.8	33.5	64.2
80%	80.9	71.9	74.5	77.6	60.5	45.1	34.7	34.3	32.6	28.1	29.2	60.6
90%	66.6	63.1	49.6	68.5	46.9	38.5	28.0	23.1	28.8	25.7	27.4	48.0
Long Term												
Full Simulation Period ^b	92.3	90.5	99.0	111.0	91.8	77.9	64.6	49.7	43.5	39.4	46.7	71.3
Water Year Types ^c												
Wet (32%)	81.9	78.0	81.5	84.3	62.9	47.3	34.4	29.3	36.0	38.3	31.8	52.8
Above Normal (16%)	102.3	98.9	100.2	117.9	92.6	67.6	51.8	40.0	38.3	30.9	30.6	68.4
Below Normal (13%)	83.0	76.4	93.2	118.9	105.1	87.3	72.3	55.6	42.1	29.8	41.9	76.6
Dry (24%)	93.8	93.9	108.7	125.6	104.6	96.0	84.6	60.0	43.1	36.3	60.2	78.2
Critical (15%)	109.9	116.0	125.1	130.0	119.7	116.2	103.2	82.0	67.2	64.9	78.4	97.9
Alternative 3 minus No Action Alternative												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	3.7	1.1	-14.6	-7.8	-13.5	0.0	-8.3	-6.0	-15.2	-1.1	1.3	-2.1
20%	4.2	0.7	-3.0	-1.7	-4.4	-4.8	-5.6	-11.2	-12.1	1.3	-3.1	1.6
30%	5.4	4.5	7.1	13.0	-1.2	-2.7	-6.6	-18.4	-8.6	0.0	-4.6	-0.5
40%	5.8	6.1	13.3	13.0	-1.0	-3.8	-7.1	-28.5	-10.5	-2.4	1.1	2.3
50%	9.2	15.0	36.4	15.3	-4.4	-8.0	-8.1	-16.6	-12.0	-2.2	0.2	0.8
60%	29.8	29.0	41.9	3.1	-9.7	-7.8	5.7	-15.2	-13.0	-1.9	0.6	-0.1
70%	29.1	24.8	41.1	0.8	-10.8	-3.5	7.2	-11.9	-13.9	-1.1	0.1	0.5
80%	30.2	22.7	33.9	-3.4	-11.4	-4.0	5.7	-2.9	-13.3	-0.8	0.4	6.4
90%	21.9	17.7	16.1	-1.3	-7.0	0.9	6.2	6.0	-9.2	-1.3	0.5	-1.3
Long Term												
Full Simulation Period ^b	14.7	13.5	16.7	3.8	-6.5	-4.3	-0.7	-11.1	-10.5	-0.8	-0.8	1.0
Water Year Types ^c												
Wet (32%)	14.7	15.6	19.2	-1.0	-8.1	-3.1	5.0	-5.9	-7.7	-0.8	0.2	-8.0
Above Normal (16%)	14.3	9.5	13.0	11.2	-6.7	-7.5	-0.7	-17.0	-13.8	-1.9	0.5	17.2
Below Normal (13%)	13.3	11.7	21.4	16.2	-0.1	-6.0	-5.3	-19.0	-14.9	-1.0	2.4	2.3
Dry (24%)	16.8	15.0	21.6	6.5	-4.6	-3.3	-4.3	-12.8	-11.9	-0.6	-4.3	0.7
Critical (15%)	13.0	12.4	2.7	-9.9	-11.8	-3.4	-2.8	-6.1	-6.4	0.6	-1.6	2.3

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.21.3. Contra Costa Victoria Canal Intake, Monthly Chloride Concentration

Statistic		Monthly Chloride Concentration (mg/L)											
		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative													
Probability of Exceedance ^a													
10%		113.4	124.0	146.2	160.4	141.4	117.2	113.6	88.1	71.9	56.9	76.0	91.4
20%		102.8	103.3	122.2	141.7	120.6	111.5	98.9	82.9	63.0	49.5	63.4	83.6
30%		96.4	93.5	108.5	120.8	111.3	98.7	89.8	79.2	56.6	44.5	58.7	80.1
40%		91.4	87.7	95.6	110.7	104.9	93.5	80.5	75.7	54.3	38.5	45.1	73.7
50%		84.6	73.4	67.3	100.4	99.6	85.1	69.9	61.4	53.2	35.7	39.2	70.5
60%		58.9	55.0	55.7	93.3	94.5	75.4	45.7	56.0	51.4	32.9	36.1	68.2
70%		56.5	51.8	48.6	86.2	87.1	63.9	37.3	49.3	48.9	30.9	33.4	63.7
80%		50.7	49.2	40.6	81.1	71.9	49.1	28.9	37.2	45.9	28.9	28.8	54.2
90%		44.8	45.3	33.5	69.8	53.8	37.6	21.8	17.2	38.0	27.0	26.9	49.3
Long Term													
Full Simulation Period ^b		77.5	77.0	82.4	107.2	98.3	82.2	65.3	60.9	53.9	40.1	47.5	70.2
Water Year Types ^c													
Wet (32%)		67.1	62.4	62.3	85.3	71.1	50.4	29.5	35.3	43.7	39.0	31.6	60.8
Above Normal (16%)		88.0	89.4	87.1	106.6	99.3	75.1	52.4	57.0	52.1	32.8	30.1	51.2
Below Normal (13%)		69.7	64.7	71.8	102.7	105.2	93.2	77.7	74.6	57.0	30.8	39.5	74.3
Dry (24%)		76.9	78.9	87.1	119.0	109.3	99.3	88.9	72.8	55.0	36.9	64.6	77.5
Critical (15%)		96.9	103.6	122.4	139.8	131.5	119.7	106.0	88.1	73.5	64.3	80.0	95.6

Alternative 5

Statistic		Monthly Chloride Concentration (mg/L)											
		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		115.0	125.3	147.3	160.3	141.4	117.2	115.1	101.4	89.3	56.4	80.7	91.2
20%		105.5	107.8	123.9	141.6	120.2	111.9	106.4	98.7	74.1	50.4	65.8	85.1
30%		97.2	92.8	108.8	120.8	112.3	98.6	95.2	85.2	67.0	45.1	58.9	81.9
40%		93.0	88.2	90.3	110.5	106.8	93.4	77.6	71.1	59.2	40.5	45.6	75.6
50%		85.2	75.4	67.6	100.4	99.6	85.0	68.1	59.3	55.9	36.7	39.0	70.7
60%		60.0	54.8	55.8	93.5	94.6	75.3	45.7	51.5	53.4	33.4	36.1	68.9
70%		56.3	51.7	48.2	86.2	87.0	63.7	37.7	47.8	51.4	31.7	32.6	64.3
80%		50.6	49.2	42.2	80.8	71.9	49.1	28.9	36.0	46.8	29.3	28.9	54.9
90%		44.6	45.5	33.5	69.8	53.8	37.6	22.2	17.2	40.5	27.4	27.0	48.7
Long Term													
Full Simulation Period ^b		78.3	77.5	82.3	107.4	98.7	82.4	67.2	63.6	59.9	40.4	48.1	70.9
Water Year Types ^c													
Wet (32%)		67.6	63.1	63.3	85.3	71.7	50.8	29.5	32.9	43.8	39.1	31.5	60.8
Above Normal (16%)		90.0	90.0	85.8	106.3	99.4	75.2	51.2	51.8	52.8	33.0	30.1	51.1
Below Normal (13%)		69.8	65.2	71.9	102.6	104.8	93.1	73.6	70.4	62.5	31.4	39.5	75.2
Dry (24%)		77.7	79.1	86.4	120.5	110.0	99.5	92.6	83.7	67.0	38.5	68.1	79.6
Critical (15%)		97.4	103.8	122.5	138.9	132.3	120.8	117.6	103.4	88.1	62.6	78.0	95.8

Alternative 5 minus No Action Alternative

Statistic		Monthly Chloride Concentration (mg/L)											
		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		1.6	1.3	1.1	-0.1	0.0	-0.1	1.5	13.4	17.3	-0.5	4.7	-0.2
20%		2.7	4.5	1.7	-0.1	-0.4	0.3	7.6	15.9	11.1	1.0	2.4	1.5
30%		0.8	-0.6	0.2	-0.1	1.0	-0.1	5.4	6.0	10.4	0.6	0.2	1.8
40%		1.7	0.5	-5.2	-0.1	1.9	-0.1	-3.0	-4.7	4.9	1.9	0.4	1.9
50%		0.6	2.1	0.3	0.0	0.1	-0.1	-1.8	-2.1	2.7	1.0	-0.2	0.3
60%		1.1	-0.2	0.0	0.2	0.0	-0.1	0.0	-4.5	2.0	0.5	0.1	0.7
70%		-0.2	-0.1	-0.4	0.0	0.0	-0.2	0.4	-1.5	2.5	0.8	-0.8	0.6
80%		-0.2	0.0	1.6	-0.3	0.0	0.0	0.0	-1.2	0.9	0.4	0.1	0.7
90%		-0.1	0.1	-0.1	0.0	0.0	0.0	0.4	0.0	2.5	0.3	0.1	-0.6
Long Term													
Full Simulation Period ^b		0.7	0.5	0.0	0.1	0.5	0.3	1.9	2.8	5.9	0.2	0.5	0.6
Water Year Types ^c													
Wet (32%)		0.5	0.7	1.0	0.0	0.6	0.4	0.1	-2.4	0.1	0.0	-0.1	0.0
Above Normal (16%)		2.0	0.7	-1.3	-0.3	0.1	0.0	-1.2	-5.2	0.7	0.2	0.0	-0.1
Below Normal (13%)		0.1	0.5	0.1	-0.1	-0.3	-0.2	-4.0	-4.1	5.5	0.5	0.0	0.8
Dry (24%)		0.8	0.2	-0.7	1.4	0.7	0.1	3.7	10.9	12.0	1.6	3.5	2.1
Critical (15%)		0.5	0.2	0.0	-0.9	0.7	1.1	11.5	15.3	14.6	-1.8	-2.0	0.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.21.4. Contra Costa Victoria Canal Intake, Monthly Chloride Concentration

Second Basis of Comparison												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	118.3	126.7	133.5	151.5	124.0	104.0	94.8	80.9	75.4	53.7	69.0	95.4
20%	107.2	101.7	119.5	136.5	112.8	86.0	79.7	75.2	61.0	48.1	54.8	83.9
30%	100.3	99.0	114.1	127.2	97.1	83.3	68.8	70.2	53.5	43.7	49.3	77.5
40%	97.6	93.6	107.5	116.9	89.3	74.2	63.4	57.4	48.8	39.3	44.7	71.7
50%	93.5	88.3	102.3	109.8	80.7	67.5	58.4	49.5	45.5	35.3	40.4	69.4
60%	89.9	84.9	99.4	83.1	69.6	61.3	51.1	45.3	42.4	31.2	35.6	67.0
70%	86.4	77.4	89.2	74.8	65.5	53.6	44.4	41.2	39.6	28.6	33.5	63.0
80%	81.2	71.3	67.8	69.1	57.1	47.1	37.0	37.0	38.3	27.9	29.6	61.1
90%	66.4	63.8	44.0	54.3	47.9	39.2	27.1	22.9	31.8	26.2	28.0	51.5
Long Term												
Full Simulation Period ^b	92.6	89.4	97.5	103.6	83.9	69.0	58.2	53.3	49.3	39.6	45.1	70.5
Water Year Types^c												
Wet (32%)	82.6	76.9	78.5	72.6	57.8	47.9	33.6	31.2	39.8	38.4	31.8	54.6
Above Normal (16%)	101.0	95.9	96.5	104.1	79.1	62.5	51.2	45.0	42.9	31.7	31.2	67.5
Below Normal (13%)	82.8	77.2	93.2	109.8	103.9	82.6	67.8	57.9	41.1	28.2	41.5	69.5
Dry (24%)	95.3	92.4	106.9	117.8	92.0	74.3	69.3	66.3	53.3	36.1	53.9	77.4
Critical (15%)	109.5	115.4	128.3	141.1	113.9	100.7	91.9	84.2	77.7	66.6	77.8	97.5
No Action Alternative												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	113.4	124.0	146.2	160.4	141.4	117.2	113.6	88.1	71.9	56.9	76.0	91.4
20%	102.8	103.3	122.2	141.7	120.6	111.5	98.9	82.9	63.0	49.5	63.4	83.6
30%	96.4	93.5	108.5	120.8	111.3	98.7	89.8	79.2	56.6	44.5	58.7	80.1
40%	91.4	87.7	95.6	110.7	104.9	93.5	80.5	75.7	54.3	38.5	45.1	73.7
50%	84.6	73.4	67.3	100.4	99.6	85.1	69.9	61.4	53.2	35.7	39.2	70.5
60%	58.9	55.0	55.7	93.3	94.5	75.4	45.7	56.0	51.4	32.9	36.1	68.2
70%	56.5	51.8	48.6	86.2	87.1	63.9	37.3	49.3	48.9	30.9	33.4	63.7
80%	50.7	49.2	40.6	81.1	71.9	49.1	28.9	37.2	45.9	28.9	28.8	54.2
90%	44.8	45.3	33.5	69.8	53.8	37.6	21.8	17.2	38.0	27.0	26.9	49.3
Long Term												
Full Simulation Period ^b	77.5	77.0	82.4	107.2	98.3	82.2	65.3	60.9	53.9	40.1	47.5	70.2
Water Year Types^c												
Wet (32%)	67.1	62.4	62.3	85.3	71.1	50.4	29.5	35.3	43.7	39.0	31.6	60.8
Above Normal (16%)	88.0	89.4	87.1	106.6	99.3	75.1	52.4	57.0	52.1	32.8	30.1	51.2
Below Normal (13%)	69.7	64.7	71.8	102.7	105.2	93.2	77.7	74.6	57.0	30.8	39.5	74.3
Dry (24%)	76.9	78.9	87.1	119.0	109.3	99.3	88.9	72.8	55.0	36.9	64.6	77.5
Critical (15%)	96.9	103.6	122.4	139.8	131.5	119.7	106.0	88.1	73.5	64.3	80.0	95.6
No Action Alternative minus Second Basis of Comparison												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-4.8	-2.7	12.7	8.9	17.4	13.2	18.8	7.2	-3.5	3.2	7.0	-4.0
20%	-4.3	1.6	2.7	5.1	7.9	25.6	19.1	7.7	2.0	1.4	8.7	-0.3
30%	-3.9	-5.5	-5.5	-6.3	14.2	15.4	21.0	9.0	3.0	0.8	9.4	2.6
40%	-6.3	-5.9	-12.0	-6.2	15.6	19.3	17.1	18.3	5.5	-0.8	0.4	1.9
50%	-8.9	-14.9	-35.0	-9.4	18.8	17.5	11.5	11.9	7.7	0.5	-1.2	1.1
60%	-31.0	-29.9	-43.6	10.2	25.0	14.1	-5.3	10.6	8.9	1.7	0.5	1.2
70%	-30.0	-25.6	-40.6	11.4	21.6	10.3	-7.1	8.1	9.4	2.3	-0.1	0.7
80%	-30.4	-22.1	-27.2	12.0	14.8	2.0	-8.1	0.2	7.6	1.0	-0.8	-6.9
90%	-21.6	-18.5	-10.4	15.5	5.9	-1.6	-5.3	-5.7	6.2	0.9	-1.1	-2.2
Long Term												
Full Simulation Period ^b	-15.0	-12.3	-15.2	3.6	14.4	13.1	7.0	7.6	4.6	0.6	2.4	-0.2
Water Year Types^c												
Wet (32%)	-15.4	-14.5	-16.2	12.7	13.3	2.6	-4.2	4.1	3.9	0.6	-0.2	6.2
Above Normal (16%)	-13.0	-6.5	-9.3	2.6	20.2	12.7	1.3	12.0	9.2	1.2	-1.0	-16.3
Below Normal (13%)	-13.1	-12.5	-21.4	-7.1	1.3	10.7	9.9	16.6	15.9	2.6	-2.0	4.8
Dry (24%)	-18.4	-13.5	-19.8	1.3	17.3	25.0	19.6	6.5	1.6	0.8	10.7	0.1
Critical (15%)	-12.6	-11.8	-5.9	-1.2	17.6	19.0	14.1	3.9	-4.2	-2.3	2.1	-1.9

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.21.5. Contra Costa Victoria Canal Intake, Monthly Chloride Concentration

Second Basis of Comparison		Monthly Chloride Concentration (mg/L)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
10%	118.3	126.7	133.5	151.5	124.0	104.0	94.8	80.9	75.4	53.7	69.0	95.4	
20%	107.2	101.7	119.5	136.5	112.8	86.0	79.7	75.2	61.0	48.1	54.8	83.9	
30%	100.3	99.0	114.1	127.2	97.1	83.3	68.8	70.2	53.5	43.7	49.3	77.5	
40%	97.6	93.6	107.5	116.9	89.3	74.2	63.4	57.4	48.8	39.3	44.7	71.7	
50%	93.5	88.3	102.3	109.8	80.7	67.5	58.4	49.5	45.5	35.3	40.4	69.4	
60%	89.9	84.9	99.4	83.1	69.6	61.3	51.1	45.3	42.4	31.2	35.6	67.0	
70%	86.4	77.4	89.2	74.8	65.5	53.6	44.4	41.2	39.6	28.6	33.5	63.0	
80%	81.2	71.3	67.8	69.1	57.1	47.1	37.0	37.0	38.3	27.9	29.6	61.1	
90%	66.4	63.8	44.0	54.3	47.9	39.2	27.1	22.9	31.8	26.2	28.0	51.5	
Long Term													
Full Simulation Period ^b	92.6	89.4	97.5	103.6	83.9	69.0	58.2	53.3	49.3	39.6	45.1	70.5	
Water Year Types ^c													
Wet (32%)	82.6	76.9	78.5	72.6	57.8	47.9	33.6	31.2	39.8	38.4	31.8	54.6	
Above Normal (16%)	101.0	95.9	96.5	104.1	79.1	62.5	51.2	45.0	42.9	31.7	31.2	67.5	
Below Normal (13%)	82.8	77.2	93.2	109.8	103.9	82.6	67.8	57.9	41.1	28.2	41.5	69.5	
Dry (24%)	95.3	92.4	106.9	117.8	92.0	74.3	69.3	66.3	53.3	36.1	53.9	77.4	
Critical (15%)	109.5	115.4	128.3	141.1	113.9	100.7	91.9	84.2	77.7	66.6	77.8	97.5	
Alternative 3													
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
10%	117.1	125.1	131.6	152.6	127.9	117.2	105.3	82.1	56.7	55.8	77.3	89.3	
20%	107.1	104.1	119.2	140.0	116.2	106.7	93.2	71.6	50.9	50.7	60.3	85.3	
30%	101.8	98.0	115.6	133.8	110.1	96.0	83.1	60.8	48.0	44.5	54.1	79.6	
40%	97.1	93.8	108.9	123.7	103.9	89.6	73.5	47.2	43.8	36.1	46.2	76.0	
50%	93.8	88.4	103.8	115.7	95.1	77.1	61.8	44.8	41.2	33.5	39.4	71.3	
60%	88.7	84.0	97.6	96.4	84.9	67.6	51.5	40.8	38.3	31.0	36.7	68.2	
70%	85.6	76.6	89.7	86.9	76.2	60.4	44.5	37.4	35.1	29.8	33.5	64.2	
80%	80.9	71.9	74.5	77.6	60.5	45.1	34.7	34.3	32.6	28.1	29.2	60.6	
90%	66.6	63.1	49.6	68.5	46.9	38.5	28.0	23.1	28.8	25.7	27.4	48.0	
Long Term													
Full Simulation Period ^b	92.3	90.5	99.0	111.0	91.8	77.9	64.6	49.7	43.5	39.4	46.7	71.3	
Water Year Types ^c													
Wet (32%)	81.9	78.0	81.5	84.3	62.9	47.3	34.4	29.3	36.0	38.3	31.8	52.8	
Above Normal (16%)	102.3	98.9	100.2	117.9	92.6	67.6	51.8	40.0	38.3	30.9	30.6	68.4	
Below Normal (13%)	83.0	76.4	93.2	118.9	105.1	87.3	72.3	55.6	42.1	29.8	41.9	76.6	
Dry (24%)	93.8	93.9	108.7	125.6	104.6	96.0	84.6	60.0	43.1	36.3	60.2	78.2	
Critical (15%)	109.9	116.0	125.1	130.0	119.7	116.2	103.2	82.0	67.2	64.9	78.4	97.9	
Alternative 3 minus Second Basis of Comparison													
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance ^a													
10%	-1.2	-1.6	-1.9	1.1	3.9	13.2	10.5	1.2	-18.7	2.1	8.3	-6.1	
20%	-0.1	2.4	-0.3	3.4	3.5	20.7	13.5	-3.6	-10.1	2.6	5.5	1.4	
30%	1.5	-1.0	1.5	6.6	13.0	12.7	14.4	-9.5	-5.6	0.8	4.8	2.1	
40%	-0.5	0.2	1.3	6.8	14.6	15.4	10.1	-10.2	-4.9	-3.2	1.5	4.2	
50%	0.3	0.1	1.4	5.9	14.4	9.6	3.4	-4.7	-4.3	-1.8	-1.0	1.9	
60%	-1.2	-0.9	-1.7	13.3	15.3	6.3	0.4	-4.5	-4.1	-0.2	1.1	1.1	
70%	-0.8	-0.8	0.5	12.2	10.8	6.8	0.1	-3.7	-4.5	1.3	0.0	1.3	
80%	-0.2	0.6	6.7	8.6	3.4	-2.1	-2.4	-2.7	-5.7	0.3	-0.4	-0.5	
90%	0.2	-0.8	5.7	14.2	-1.1	-0.7	0.9	0.2	-3.0	-0.5	-0.5	-3.5	
Long Term													
Full Simulation Period ^b	-0.3	1.1	1.5	7.4	7.8	8.8	6.3	-3.5	-5.8	-0.2	1.6	0.8	
Water Year Types ^c													
Wet (32%)	-0.7	1.1	3.0	11.7	5.1	-0.5	0.8	-1.8	-3.8	-0.2	0.0	-1.8	
Above Normal (16%)	1.3	3.0	3.7	13.8	13.4	5.1	0.6	-5.0	-4.6	-0.7	-0.5	0.9	
Below Normal (13%)	0.2	-0.8	0.0	9.1	1.2	4.7	4.5	-2.3	1.0	1.6	0.4	7.1	
Dry (24%)	-1.6	1.4	1.8	7.8	12.6	21.7	15.3	-6.3	-10.2	0.2	6.4	0.9	
Critical (15%)	0.4	0.6	-3.2	-11.1	5.9	15.5	11.2	-2.1	-10.6	-1.7	0.6	0.4	

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
b Based on the 82-year simulation period.
c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.21.6. Contra Costa Victoria Canal Intake, Monthly Chloride Concentration

Second Basis of Comparison		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		118.3	126.7	133.5	151.5	124.0	104.0	94.8	80.9	75.4	53.7	69.0	95.4
20%		107.2	101.7	119.5	136.5	112.8	86.0	79.7	75.2	61.0	48.1	54.8	83.9
30%		100.3	99.0	114.1	127.2	97.1	83.3	68.8	70.2	53.5	43.7	49.3	77.5
40%		97.6	93.6	107.5	116.9	89.3	74.2	63.4	57.4	48.8	39.3	44.7	71.7
50%		93.5	88.3	102.3	109.8	80.7	67.5	58.4	49.5	45.5	35.3	40.4	69.4
60%		89.9	84.9	99.4	83.1	69.6	61.3	51.1	45.3	42.4	31.2	35.6	67.0
70%		86.4	77.4	89.2	74.8	65.5	53.6	44.4	41.2	39.6	28.6	33.5	63.0
80%		81.2	71.3	67.8	69.1	57.1	47.1	37.0	37.0	38.3	27.9	29.6	61.1
90%		66.4	63.8	44.0	54.3	47.9	39.2	27.1	22.9	31.8	26.2	28.0	51.5
Long Term													
Full Simulation Period ^b		92.6	89.4	97.5	103.6	83.9	69.0	58.2	53.3	49.3	39.6	45.1	70.5
Water Year Types ^c													
Wet (32%)		82.6	76.9	78.5	72.6	57.8	47.9	33.6	31.2	39.8	38.4	31.8	54.6
Above Normal (16%)		101.0	95.9	96.5	104.1	79.1	62.5	51.2	45.0	42.9	31.7	31.2	67.5
Below Normal (13%)		82.8	77.2	93.2	109.8	103.9	82.6	67.8	57.9	41.1	28.2	41.5	69.5
Dry (24%)		95.3	92.4	106.9	117.8	92.0	74.3	69.3	66.3	53.3	36.1	53.9	77.4
Critical (15%)		109.5	115.4	128.3	141.1	113.9	100.7	91.9	84.2	77.7	66.6	77.8	97.5

Alternative 5

Alternative 5		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		115.0	125.3	147.3	160.3	141.4	117.2	115.1	101.4	89.3	56.4	80.7	91.2
20%		105.5	107.8	123.9	141.6	120.2	111.9	106.4	98.7	74.1	50.4	65.8	85.1
30%		97.2	92.8	108.8	120.8	112.3	98.6	95.2	85.2	67.0	45.1	58.9	81.9
40%		93.0	88.2	90.3	110.5	106.8	93.4	77.6	71.1	59.2	40.5	45.6	75.6
50%		85.2	75.4	67.6	100.4	99.6	85.0	68.1	59.3	55.9	36.7	39.0	70.7
60%		60.0	54.8	55.8	93.5	94.6	75.3	45.7	51.5	53.4	33.4	36.1	68.9
70%		56.3	51.7	48.2	86.2	87.0	63.7	37.7	47.8	51.4	31.7	32.6	64.3
80%		50.6	49.2	42.2	80.8	71.9	49.1	28.9	36.0	46.8	29.3	28.9	54.9
90%		44.6	45.5	33.5	69.8	53.8	37.6	22.2	17.2	40.5	27.4	27.0	48.7
Long Term													
Full Simulation Period ^b		78.3	77.5	82.3	107.4	98.7	82.4	67.2	63.6	59.9	40.4	48.1	70.9
Water Year Types ^c													
Wet (32%)		67.6	63.1	63.3	85.3	71.7	50.8	29.5	32.9	43.8	39.1	31.5	60.8
Above Normal (16%)		90.0	90.0	85.8	106.3	99.4	75.2	51.2	51.8	52.8	33.0	30.1	51.1
Below Normal (13%)		69.8	65.2	71.9	102.6	104.8	93.1	73.6	70.4	62.5	31.4	39.5	75.2
Dry (24%)		77.7	79.1	86.4	120.5	110.0	99.5	92.6	83.7	67.0	38.5	68.1	79.6
Critical (15%)		97.4	103.8	122.5	138.9	132.3	120.8	117.6	103.4	88.1	62.6	78.0	95.8

Alternative 5 minus Second Basis of Comparison

Alternative 5 minus Second Basis of Comparison		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		-3.2	-1.5	13.8	8.8	17.4	13.2	20.4	20.5	13.9	2.7	11.7	-4.2
20%		-1.6	6.2	4.4	5.1	7.4	25.9	26.7	23.5	13.2	2.3	11.1	1.2
30%		-3.1	-6.1	-5.3	-6.4	15.2	15.3	26.4	14.9	13.5	1.4	9.6	4.4
40%		-4.6	-5.4	-17.2	-6.4	17.5	19.2	14.1	13.6	10.4	1.2	0.9	3.8
50%		-8.3	-12.9	-34.7	-9.4	18.9	17.4	9.7	9.8	10.3	1.4	-1.4	1.3
60%		-29.9	-30.1	-43.6	10.4	25.0	14.0	-5.4	6.2	10.9	2.2	0.5	1.9
70%		-30.1	-25.6	-40.9	11.4	21.6	10.1	-6.7	6.6	11.9	3.1	-0.8	1.3
80%		-30.6	-22.1	-25.6	11.7	14.8	2.0	-8.1	-1.0	8.5	1.4	-0.8	-6.2
90%		-21.8	-18.4	-10.5	15.4	5.9	-1.5	-4.9	-5.7	8.7	1.2	-1.0	-2.8
Long Term													
Full Simulation Period ^b		-14.3	-11.9	-15.2	3.7	14.8	13.4	8.9	10.4	10.6	0.8	3.0	0.4
Water Year Types ^c													
Wet (32%)		-15.0	-13.8	-15.2	12.7	13.9	3.0	-4.1	1.8	4.0	0.6	-0.3	6.2
Above Normal (16%)		-11.0	-5.9	-10.6	2.2	20.3	12.7	0.0	6.8	9.9	1.3	-1.0	-16.4
Below Normal (13%)		-13.0	-12.0	-21.3	-7.2	0.9	10.5	5.8	12.5	21.4	3.1	-2.0	5.6
Dry (24%)		-17.6	-13.3	-20.5	2.7	18.0	25.2	23.3	17.4	13.6	2.4	14.2	2.2
Critical (15%)		-12.1	-11.6	-5.9	-2.2	18.4	20.0	25.6	19.3	10.4	-4.0	0.2	-1.7

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1 **B.22. Antioch Chloride Concentration**
2

Table 6E.B.22.1. Antioch, Monthly Chloride Concentration

No Action Alternative												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,306.8	2,378.9	1,877.6	896.3	275.6	169.8	243.1	413.9	574.8	1,181.9	1,634.2	1,991.5
20%	2,029.7	1,951.0	1,489.9	724.0	142.6	98.4	110.6	306.3	508.7	950.6	1,390.3	1,853.0
30%	1,987.9	1,847.5	864.7	524.3	81.6	39.3	61.6	212.9	453.7	831.9	1,325.3	1,801.7
40%	1,902.8	1,463.3	712.0	300.6	51.8	27.3	32.1	88.2	381.6	596.4	1,070.0	1,654.6
50%	1,698.8	556.1	571.1	243.4	32.5	24.2	25.4	51.5	277.9	480.9	935.8	1,419.7
60%	504.0	474.1	466.9	72.5	27.6	22.7	22.9	30.9	227.7	321.5	875.4	590.5
70%	177.2	170.5	152.8	27.1	23.8	21.4	21.7	23.7	140.0	278.6	814.8	353.0
80%	162.3	143.4	74.7	23.1	21.6	20.1	20.9	21.2	65.8	251.3	751.3	326.8
90%	136.7	126.9	22.7	20.2	19.8	18.0	19.9	18.0	19.4	186.2	700.1	297.5
Long Term												
Full Simulation Period ^b	1,191.9	1,037.9	740.4	359.1	115.2	64.3	82.1	159.1	345.8	599.4	1,066.3	1,139.3
Water Year Types^c												
Wet (32%)	788.6	570.4	198.8	62.0	25.3	21.1	21.4	26.7	109.7	212.5	749.2	304.4
Above Normal (16%)	1,556.8	1,108.7	623.9	160.1	33.0	22.1	23.0	37.7	224.5	305.3	770.2	589.2
Below Normal (13%)	810.0	761.1	727.9	396.3	116.1	66.4	74.2	141.5	362.7	509.0	950.8	1,575.6
Dry (24%)	1,287.5	1,230.9	1,063.7	557.0	161.5	67.1	86.0	187.1	408.4	887.7	1,344.1	1,790.2
Critical (15%)	1,860.9	1,906.5	1,513.1	854.5	321.3	197.1	278.6	546.6	869.0	1,358.8	1,716.9	2,059.1
Alternative 1												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,265.0	2,355.0	1,907.3	1,272.0	492.3	269.2	293.5	441.8	585.2	1,185.7	1,725.6	2,024.3
20%	1,989.6	1,973.6	1,852.9	1,080.6	267.2	115.6	164.1	306.8	504.9	950.1	1,463.9	1,915.1
30%	1,940.6	1,926.3	1,738.7	840.7	163.3	52.8	110.4	278.8	413.0	833.4	1,359.2	1,776.1
40%	1,883.9	1,853.0	1,562.7	487.3	89.4	34.9	64.6	142.7	315.6	570.4	1,146.3	1,678.9
50%	1,822.7	1,785.0	1,224.9	346.5	48.4	26.3	36.1	91.7	246.1	488.7	943.4	1,564.7
60%	1,785.1	1,679.0	789.1	173.4	28.3	23.6	24.3	55.6	204.4	348.3	891.2	1,486.9
70%	1,717.9	1,628.2	390.6	33.1	24.3	22.0	21.0	29.6	158.1	315.1	836.9	1,443.8
80%	1,629.3	1,437.3	231.9	23.7	20.9	20.0	19.6	18.4	79.9	251.7	786.8	1,381.2
90%	1,329.1	532.1	74.8	20.2	19.5	17.9	18.7	16.4	19.2	193.0	710.8	1,277.3
Long Term												
Full Simulation Period ^b	1,768.0	1,625.2	1,095.5	503.4	168.1	83.8	100.2	187.2	337.2	607.7	1,100.7	1,585.7
Water Year Types^c												
Wet (32%)	1,560.8	1,366.5	426.2	92.4	27.4	21.2	23.8	37.0	99.7	226.7	761.2	1,243.5
Above Normal (16%)	1,916.5	1,571.0	1,047.8	285.6	51.2	22.6	29.2	65.4	196.2	317.2	809.4	1,433.2
Below Normal (13%)	1,647.4	1,433.8	1,199.6	735.0	243.8	96.9	107.8	190.2	304.9	524.4	1,023.0	1,608.1
Dry (24%)	1,848.5	1,825.8	1,518.3	788.7	236.1	88.0	110.8	216.2	408.0	873.5	1,387.6	1,827.7
Critical (15%)	2,032.6	2,085.8	1,797.1	941.8	417.1	266.8	318.1	593.5	916.2	1,381.0	1,744.9	2,068.3
Alternative 1 minus No Action Alternative												
Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-41.8	-23.9	29.8	375.7	216.7	99.4	50.4	27.9	10.3	3.8	91.4	32.8
20%	-40.1	22.6	363.0	356.6	124.5	17.2	53.4	0.6	-3.8	-0.6	73.6	62.0
30%	-47.3	78.8	874.0	316.4	81.8	13.4	48.8	65.9	-40.7	1.5	33.9	-25.7
40%	-18.8	389.7	850.7	186.8	37.6	7.6	32.5	54.5	-66.0	-26.0	76.3	24.3
50%	123.9	1,228.9	653.8	103.0	16.0	2.1	10.6	40.2	-31.7	7.8	7.6	145.0
60%	1,281.0	1,205.0	322.2	100.8	0.7	0.9	1.5	24.8	-23.2	26.9	15.7	896.5
70%	1,540.7	1,457.7	237.8	6.0	0.6	0.6	-0.7	5.9	18.1	36.5	22.1	1,090.7
80%	1,467.0	1,294.0	157.2	0.6	-0.7	-0.1	-1.3	-2.8	14.2	0.4	35.5	1,054.4
90%	1,192.3	405.2	52.1	0.0	-0.3	-0.2	-1.2	-1.6	-0.2	6.8	10.8	979.8
Long Term												
Full Simulation Period ^b	576.1	587.3	355.0	144.3	52.9	19.5	18.1	28.1	-8.6	8.2	34.4	446.4
Water Year Types^c												
Wet (32%)	772.2	796.1	227.4	30.4	2.1	0.2	2.4	10.3	-10.0	14.2	12.0	939.1
Above Normal (16%)	359.7	462.3	424.0	125.4	18.2	0.5	6.2	27.7	-28.4	11.9	39.2	843.9
Below Normal (13%)	837.4	672.7	471.7	338.7	127.6	30.5	33.6	48.7	-57.8	15.4	72.2	32.5
Dry (24%)	561.0	594.9	454.6	231.7	74.5	20.8	24.8	29.1	-0.5	-14.2	43.5	37.5
Critical (15%)	171.7	179.4	284.0	87.3	95.8	69.7	39.4	46.9	47.2	22.2	28.0	9.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
b Based on the 82-year simulation period.
c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.22.2. Antioch, Monthly Chloride Concentration

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
No Action Alternative												
Probability of Exceedance ^a												
10%	2,306.8	2,378.9	1,877.6	896.3	275.6	169.8	243.1	413.9	574.8	1,181.9	1,634.2	1,991.5
20%	2,029.7	1,951.0	1,489.9	724.0	142.6	98.4	110.6	306.3	508.7	950.6	1,390.3	1,853.0
30%	1,987.9	1,847.5	864.7	524.3	81.6	39.3	61.6	212.9	453.7	831.9	1,325.3	1,801.7
40%	1,902.8	1,463.3	712.0	300.6	51.8	27.3	32.1	88.2	381.6	596.4	1,070.0	1,654.6
50%	1,698.8	556.1	571.1	243.4	32.5	24.2	25.4	51.5	277.9	480.9	935.8	1,419.7
60%	504.0	474.1	466.9	72.5	27.6	22.7	22.9	30.9	227.7	321.5	875.4	590.5
70%	177.2	170.5	152.8	27.1	23.8	21.4	21.7	23.7	140.0	278.6	814.8	353.0
80%	162.3	143.4	74.7	23.1	21.6	20.1	20.9	21.2	65.8	251.3	751.3	326.8
90%	136.7	126.9	22.7	20.2	19.8	18.0	19.9	18.0	19.4	186.2	700.1	297.5
Long Term												
Full Simulation Period ^b	1,191.9	1,037.9	740.4	359.1	115.2	64.3	82.1	159.1	345.8	599.4	1,066.3	1,139.3
Water Year Types ^c												
Wet (32%)	788.6	570.4	198.8	62.0	25.3	21.1	21.4	26.7	109.7	212.5	749.2	304.4
Above Normal (16%)	1,556.8	1,108.7	623.9	160.1	33.0	22.1	23.0	37.7	224.5	305.3	770.2	589.2
Below Normal (13%)	810.0	761.1	727.9	396.3	116.1	66.4	74.2	141.5	362.7	509.0	950.8	1,575.6
Dry (24%)	1,287.5	1,230.9	1,063.7	557.0	161.5	67.1	86.0	187.1	408.4	887.7	1,344.1	1,790.2
Critical (15%)	1,860.9	1,906.5	1,513.1	854.5	321.3	197.1	278.6	546.6	869.0	1,358.8	1,716.9	2,059.1

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 3												
Probability of Exceedance ^a												
10%	2,263.5	2,383.5	1,905.6	1,036.4	287.5	164.4	238.6	463.7	603.2	1,094.6	1,653.6	2,026.6
20%	2,029.1	2,019.2	1,843.4	846.5	144.7	101.1	148.0	328.2	527.8	950.8	1,466.8	1,897.7
30%	1,961.3	1,923.3	1,696.0	662.1	83.9	35.5	93.0	251.0	476.0	837.9	1,302.0	1,792.8
40%	1,887.4	1,875.6	1,442.8	352.8	48.3	26.9	53.0	161.4	396.4	556.5	1,075.1	1,622.3
50%	1,824.1	1,793.3	1,220.7	242.8	31.7	24.2	34.9	112.8	303.4	499.7	915.8	1,520.4
60%	1,752.5	1,700.4	788.5	95.7	27.2	22.6	24.3	69.9	242.0	330.2	873.4	1,455.8
70%	1,710.1	1,614.7	332.7	28.3	23.9	21.0	20.6	30.1	180.3	284.8	779.3	1,394.5
80%	1,636.5	1,409.1	234.3	23.5	21.3	19.8	19.5	18.8	99.5	263.0	765.0	1,355.0
90%	1,438.5	595.6	89.2	21.4	19.5	17.8	18.4	16.4	20.6	193.9	686.6	1,316.7
Long Term												
Full Simulation Period ^b	1,786.9	1,649.7	1,064.4	409.9	119.2	64.5	91.5	190.0	371.9	604.1	1,073.0	1,568.1
Water Year Types ^c												
Wet (32%)	1,550.8	1,384.8	410.3	73.6	24.6	21.2	23.4	43.0	128.1	221.3	731.2	1,232.1
Above Normal (16%)	1,985.9	1,594.9	982.2	200.1	31.7	21.0	27.7	70.3	235.7	311.9	784.4	1,418.3
Below Normal (13%)	1,677.7	1,465.7	1,202.6	512.9	126.9	69.1	97.2	197.0	404.0	514.3	944.1	1,525.3
Dry (24%)	1,850.8	1,852.8	1,501.1	624.9	158.7	66.5	97.8	222.1	439.1	871.8	1,365.7	1,819.3
Critical (15%)	2,076.6	2,113.1	1,716.3	913.2	346.3	198.1	292.6	578.5	906.0	1,385.8	1,756.4	2,079.1

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Alternative 3 minus No Action Alternative												
Probability of Exceedance ^a												
10%	-43.3	4.6	28.0	140.1	12.0	-5.4	-4.6	49.8	28.4	-87.2	19.4	35.1
20%	-0.6	68.2	353.5	122.5	2.1	2.7	37.4	21.9	19.1	0.1	76.6	44.7
30%	-26.6	75.8	831.3	137.8	2.4	-3.8	31.4	38.1	22.3	6.0	-23.3	-8.9
40%	-15.4	412.3	730.8	52.3	-3.4	-0.4	20.9	73.1	14.8	-39.9	5.1	-32.3
50%	125.3	1,237.2	649.6	-0.7	-0.8	0.0	9.5	61.3	25.5	18.7	-20.0	100.7
60%	1,248.5	1,226.3	321.6	23.2	-0.4	-0.1	1.4	39.0	14.3	8.8	-2.0	865.4
70%	1,532.9	1,444.3	179.9	1.2	0.1	-0.3	-1.1	6.3	40.3	6.2	-35.5	1,041.5
80%	1,474.2	1,265.8	159.6	0.4	-0.3	-0.3	-1.4	-2.4	33.7	11.7	13.7	1,028.1
90%	1,301.8	468.7	66.5	1.3	-0.3	-0.2	-1.5	-1.6	1.3	7.8	-13.4	1,019.2
Long Term												
Full Simulation Period ^b	595.0	611.8	324.0	50.8	4.0	0.2	9.4	31.0	26.0	4.6	6.7	428.8
Water Year Types ^c												
Wet (32%)	762.2	814.4	211.5	11.6	-0.7	0.1	1.9	16.3	18.4	8.8	-18.0	927.6
Above Normal (16%)	429.1	486.3	358.3	40.0	-1.2	-1.2	4.7	32.6	11.1	6.7	14.2	829.1
Below Normal (13%)	867.7	704.6	474.7	116.7	10.8	2.7	23.0	55.4	41.3	5.3	-6.7	-50.3
Dry (24%)	563.3	621.9	437.4	67.9	-2.8	-0.7	11.8	35.0	30.7	-15.9	21.6	29.1
Critical (15%)	215.7	206.6	203.2	58.6	25.0	1.0	14.0	31.9	37.0	27.0	39.5	20.0

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.22.3. Antioch, Monthly Chloride Concentration

No Action Alternative		Monthly Chloride Concentration (mg/L)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	2,306.8	2,378.9	1,877.6	896.3	275.6	169.8	243.1	413.9	574.8	1,181.9	1,634.2	1,991.5	
20%	2,029.7	1,951.0	1,489.9	724.0	142.6	98.4	110.6	306.3	508.7	950.6	1,390.3	1,853.0	
30%	1,987.9	1,847.5	864.7	524.3	81.6	39.3	61.6	212.9	453.7	831.9	1,325.3	1,801.7	
40%	1,902.8	1,463.3	712.0	300.6	51.8	27.3	32.1	88.2	381.6	596.4	1,070.0	1,654.6	
50%	1,698.8	556.1	571.1	243.4	32.5	24.2	25.4	51.5	277.9	480.9	935.8	1,419.7	
60%	504.0	474.1	466.9	72.5	27.6	22.7	22.9	30.9	227.7	321.5	875.4	590.5	
70%	177.2	170.5	152.8	27.1	23.8	21.4	21.7	23.7	140.0	278.6	814.8	353.0	
80%	162.3	143.4	74.7	23.1	21.6	20.1	20.9	21.2	65.8	251.3	751.3	326.8	
90%	136.7	126.9	22.7	20.2	19.8	18.0	19.9	18.0	19.4	186.2	700.1	297.5	
Long Term													
Full Simulation Period ^b	1,191.9	1,037.9	740.4	359.1	115.2	64.3	82.1	159.1	345.8	599.4	1,066.3	1,139.3	
Water Year Types^c													
Wet (32%)	788.6	570.4	198.8	62.0	25.3	21.1	21.4	26.7	109.7	212.5	749.2	304.4	
Above Normal (16%)	1,556.8	1,108.7	623.9	160.1	33.0	22.1	23.0	37.7	224.5	305.3	770.2	589.2	
Below Normal (13%)	810.0	761.1	727.9	396.3	116.1	66.4	74.2	141.5	362.7	509.0	950.8	1,575.6	
Dry (24%)	1,287.5	1,230.9	1,063.7	557.0	161.5	67.1	86.0	187.1	408.4	887.7	1,344.1	1,790.2	
Critical (15%)	1,860.9	1,906.5	1,513.1	854.5	321.3	197.1	278.6	546.6	869.0	1,358.8	1,716.9	2,059.1	

Alternative 5		Monthly Chloride Concentration (mg/L)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	2,318.4	2,329.0	1,880.5	894.9	283.0	171.2	180.5	305.6	542.6	1,168.9	1,645.8	2,019.5	
20%	2,067.2	1,960.8	1,453.7	728.0	142.6	98.5	96.5	216.1	474.0	930.8	1,405.6	1,866.4	
30%	1,996.2	1,845.5	867.0	525.0	85.1	39.5	51.0	157.7	436.7	824.4	1,346.1	1,814.0	
40%	1,889.7	1,458.6	711.9	300.4	51.7	27.3	30.8	79.3	361.9	597.7	1,066.2	1,659.4	
50%	1,662.8	554.9	572.7	243.2	32.5	24.2	25.5	45.9	268.8	482.3	930.9	1,386.6	
60%	504.4	471.1	466.9	72.3	27.5	22.7	23.2	30.6	226.5	322.3	875.2	591.4	
70%	175.4	170.6	162.5	27.2	23.7	21.3	21.8	23.7	141.9	281.2	809.1	355.0	
80%	160.9	143.3	60.8	23.2	21.6	20.0	20.8	21.4	66.5	251.3	737.0	325.4	
90%	136.6	126.3	22.5	20.2	19.8	18.1	19.9	18.0	19.4	189.6	691.9	297.5	
Long Term													
Full Simulation Period ^b	1,190.8	1,034.6	742.1	365.7	119.4	64.8	68.8	128.1	326.1	592.7	1,063.4	1,138.9	
Water Year Types^c													
Wet (32%)	788.0	578.0	200.3	62.0	25.3	21.1	21.4	25.4	109.7	210.2	740.5	304.0	
Above Normal (16%)	1,556.0	1,087.3	616.5	159.7	33.0	22.1	23.1	36.9	224.1	305.7	769.6	590.6	
Below Normal (13%)	812.6	762.8	728.3	397.2	116.0	66.4	62.7	116.2	355.8	507.7	944.0	1,562.5	
Dry (24%)	1,285.7	1,223.1	1,071.6	563.7	163.0	67.4	66.8	147.9	391.0	884.2	1,347.1	1,795.2	
Critical (15%)	1,855.9	1,901.7	1,515.8	888.2	347.6	199.8	230.0	426.9	769.9	1,324.0	1,717.6	2,060.0	

Alternative 5 minus No Action Alternative		Monthly Chloride Concentration (mg/L)											
Statistic	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	
Probability of Exceedance^a													
10%	11.6	-49.9	2.9	-1.4	7.4	1.4	-62.6	-108.3	-32.2	-13.0	11.6	28.0	
20%	37.6	9.9	-36.2	4.0	0.0	0.0	-14.1	-90.2	-34.6	-19.9	15.3	13.4	
30%	8.2	-2.0	2.3	0.7	3.6	0.1	-10.7	-55.2	-17.1	-7.5	20.9	12.2	
40%	-13.1	-4.7	-0.1	-0.2	-0.1	0.0	-1.3	-8.9	-19.7	1.2	-3.8	4.7	
50%	-35.9	-1.1	1.6	-0.2	0.1	0.0	0.1	-5.6	-9.1	1.3	-4.9	-33.1	
60%	0.4	-3.0	0.0	-0.2	-0.1	0.0	0.3	-0.3	-1.2	0.8	-0.2	0.9	
70%	-1.8	0.1	9.7	0.1	0.0	-0.1	0.1	0.0	2.0	2.6	-5.7	2.0	
80%	-1.5	-0.1	-13.9	0.1	0.0	-0.1	0.0	0.3	0.8	0.0	-14.3	-1.5	
90%	-0.1	-0.6	-0.2	0.0	0.0	0.0	0.0	0.0	0.0	3.4	-8.1	0.0	
Long Term													
Full Simulation Period ^b	-1.1	-3.3	1.7	6.6	4.2	0.5	-13.3	-31.0	-19.8	-6.8	-2.9	-0.3	
Water Year Types^c													
Wet (32%)	-0.6	7.6	1.5	0.0	0.0	0.0	0.0	-1.3	0.0	-2.3	-8.7	-0.4	
Above Normal (16%)	-0.8	-21.3	-7.4	-0.4	0.0	0.0	0.1	-0.8	-0.5	0.4	-0.6	1.4	
Below Normal (13%)	2.6	1.7	0.4	0.9	-0.1	-0.1	-11.5	-25.3	-6.9	-1.3	-6.8	-13.1	
Dry (24%)	-1.8	-7.7	7.9	6.7	1.5	0.3	-19.2	-39.2	-17.4	-3.5	3.0	5.0	
Critical (15%)	-4.9	-4.8	2.7	33.7	26.2	2.7	-48.6	-119.7	-99.1	-34.8	0.7	0.9	

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.22.4. Antioch, Monthly Chloride Concentration

Second Basis of Comparison		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a													
10%		2,265.0	2,355.0	1,907.3	1,272.0	492.3	269.2	293.5	441.8	585.2	1,185.7	1,725.6	2,024.3
20%		1,989.6	1,973.6	1,852.9	1,080.6	267.2	115.6	164.1	306.8	504.9	950.1	1,463.9	1,915.1
30%		1,940.6	1,926.3	1,738.7	840.7	163.3	52.8	110.4	278.8	413.0	833.4	1,359.2	1,776.1
40%		1,883.9	1,853.0	1,562.7	487.3	89.4	34.9	64.6	142.7	315.6	570.4	1,146.3	1,678.9
50%		1,822.7	1,785.0	1,224.9	346.5	48.4	26.3	36.1	91.7	246.1	488.7	943.4	1,564.7
60%		1,785.1	1,679.0	789.1	173.4	28.3	23.6	24.3	55.6	204.4	348.3	891.2	1,486.9
70%		1,717.9	1,628.2	390.6	33.1	24.3	22.0	21.0	29.6	158.1	315.1	836.9	1,443.8
80%		1,629.3	1,437.3	231.9	23.7	20.9	20.0	19.6	18.4	79.9	251.7	786.8	1,381.2
90%		1,329.1	532.1	74.8	20.2	19.5	17.9	18.7	16.4	19.2	193.0	710.8	1,277.3
Long Term													
Full Simulation Period ^b		1,768.0	1,625.2	1,095.5	503.4	168.1	83.8	100.2	187.2	337.2	607.7	1,100.7	1,585.7
Water Year Types^c													
Wet (32%)		1,560.8	1,366.5	426.2	92.4	27.4	21.2	23.8	37.0	99.7	226.7	761.2	1,243.5
Above Normal (16%)		1,916.5	1,571.0	1,047.8	285.6	51.2	22.6	29.2	65.4	196.2	317.2	809.4	1,433.2
Below Normal (13%)		1,647.4	1,433.8	1,199.6	735.0	243.8	96.9	107.8	190.2	304.9	524.4	1,023.0	1,608.1
Dry (24%)		1,848.5	1,825.8	1,518.3	788.7	236.1	88.0	110.8	216.2	408.0	873.5	1,387.6	1,827.7
Critical (15%)		2,032.6	2,085.8	1,797.1	941.8	417.1	266.8	318.1	593.5	916.2	1,381.0	1,744.9	2,068.3

No Action Alternative

No Action Alternative		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a													
10%		2,306.8	2,378.9	1,877.6	896.3	275.6	169.8	243.1	413.9	574.8	1,181.9	1,634.2	1,991.5
20%		2,029.7	1,951.0	1,489.9	724.0	142.6	98.4	110.6	306.3	508.7	950.6	1,390.3	1,853.0
30%		1,987.9	1,847.5	864.7	524.3	81.6	39.3	61.6	212.9	453.7	831.9	1,325.3	1,801.7
40%		1,902.8	1,463.3	712.0	300.6	51.8	27.3	32.1	88.2	381.6	596.4	1,070.0	1,654.6
50%		1,698.8	556.1	571.1	243.4	32.5	24.2	25.4	51.5	277.9	480.9	935.8	1,419.7
60%		504.0	474.1	466.9	72.5	27.6	22.7	22.9	30.9	227.7	321.5	875.4	590.5
70%		177.2	170.5	152.8	27.1	23.8	21.4	21.7	23.7	140.0	278.6	814.8	353.0
80%		162.3	143.4	74.7	23.1	21.6	20.1	20.9	21.2	65.8	251.3	751.3	326.8
90%		136.7	126.9	22.7	20.2	19.8	18.0	19.9	18.0	19.4	186.2	700.1	297.5
Long Term													
Full Simulation Period ^b		1,191.9	1,037.9	740.4	359.1	115.2	64.3	82.1	159.1	345.8	599.4	1,066.3	1,139.3
Water Year Types^c													
Wet (32%)		788.6	570.4	198.8	62.0	25.3	21.1	21.4	26.7	109.7	212.5	749.2	304.4
Above Normal (16%)		1,556.8	1,108.7	623.9	160.1	33.0	22.1	23.0	37.7	224.5	305.3	770.2	589.2
Below Normal (13%)		810.0	761.1	727.9	396.3	116.1	66.4	74.2	141.5	362.7	509.0	950.8	1,575.6
Dry (24%)		1,287.5	1,230.9	1,063.7	557.0	161.5	67.1	86.0	187.1	408.4	887.7	1,344.1	1,790.2
Critical (15%)		1,860.9	1,906.5	1,513.1	854.5	321.3	197.1	278.6	546.6	869.0	1,358.8	1,716.9	2,059.1

No Action Alternative minus Second Basis of Comparison

No Action Alternative minus Second Basis of Comparison		Monthly Chloride Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a													
10%		41.8	23.9	-29.8	-375.7	-216.7	-99.4	-50.4	-27.9	-10.3	-3.8	-91.4	-32.8
20%		40.1	-22.6	-363.0	-356.6	-124.5	-17.2	-53.4	-0.6	3.8	0.6	-73.6	-62.0
30%		47.3	-78.8	-874.0	-316.4	-81.8	-13.4	-48.8	-65.9	40.7	-1.5	-33.9	25.7
40%		18.8	-389.7	-850.7	-186.8	-37.6	-7.6	-32.5	-54.5	66.0	26.0	-76.3	-24.3
50%		-123.9	-1,228.9	-653.8	-103.0	-16.0	-2.1	-10.6	-40.2	31.7	-7.8	-7.6	-145.0
60%		-1,281.0	-1,205.0	-322.2	-100.8	-0.7	-0.9	-1.5	-24.8	23.2	-26.9	-15.7	-896.5
70%		-1,540.7	-1,457.7	-237.8	-6.0	-0.6	-0.6	0.7	-5.9	-18.1	-36.5	-22.1	-1,090.7
80%		-1,467.0	-1,294.0	-157.2	-0.6	0.7	0.1	1.3	2.8	-14.2	-0.4	-35.5	-1,054.4
90%		-1,192.3	-405.2	-52.1	0.0	0.3	0.2	1.2	1.6	0.2	-6.8	-10.8	-979.8
Long Term													
Full Simulation Period ^b		-576.1	-587.3	-355.0	-144.3	-52.9	-19.5	-18.1	-28.1	8.6	-8.2	-34.4	-446.4
Water Year Types^c													
Wet (32%)		-772.2	-796.1	-227.4	-30.4	-2.1	-0.2	-2.4	-10.3	10.0	-14.2	-12.0	-939.1
Above Normal (16%)		-359.7	-462.3	-424.0	-125.4	-18.2	-0.5	-6.2	-27.7	28.4	-11.9	-39.2	-843.9
Below Normal (13%)		-837.4	-672.7	-471.7	-338.7	-127.6	-30.5	-33.6	-48.7	57.8	-15.4	-72.2	-32.5
Dry (24%)		-561.0	-594.9	-454.6	-231.7	-74.5	-20.8	-24.8	-29.1	0.5	14.2	-43.5	-37.5
Critical (15%)		-171.7	-179.4	-284.0	-87.3	-95.8	-69.7	-39.4	-46.9	-47.2	-22.2	-28.0	-9.2

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.22.5. Antioch, Monthly Chloride Concentration

Second Basis of Comparison

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,265.0	2,355.0	1,907.3	1,272.0	492.3	269.2	293.5	441.8	585.2	1,185.7	1,725.6	2,024.3
20%	1,989.6	1,973.6	1,852.9	1,080.6	267.2	115.6	164.1	306.8	504.9	950.1	1,463.9	1,915.1
30%	1,940.6	1,926.3	1,738.7	840.7	163.3	52.8	110.4	278.8	413.0	833.4	1,359.2	1,776.1
40%	1,883.9	1,853.0	1,562.7	487.3	89.4	34.9	64.6	142.7	315.6	570.4	1,146.3	1,678.9
50%	1,822.7	1,785.0	1,224.9	346.5	48.4	26.3	36.1	91.7	246.1	488.7	943.4	1,564.7
60%	1,785.1	1,679.0	789.1	173.4	28.3	23.6	24.3	55.6	204.4	348.3	891.2	1,486.9
70%	1,717.9	1,628.2	390.6	33.1	24.3	22.0	21.0	29.6	158.1	315.1	836.9	1,443.8
80%	1,629.3	1,437.3	231.9	23.7	20.9	20.0	19.6	18.4	79.9	251.7	786.8	1,381.2
90%	1,329.1	532.1	74.8	20.2	19.5	17.9	18.7	16.4	19.2	193.0	710.8	1,277.3
Long Term												
Full Simulation Period ^b	1,768.0	1,625.2	1,095.5	503.4	168.1	83.8	100.2	187.2	337.2	607.7	1,100.7	1,585.7
Water Year Types^c												
Wet (32%)	1,560.8	1,366.5	426.2	92.4	27.4	21.2	23.8	37.0	99.7	226.7	761.2	1,243.5
Above Normal (16%)	1,916.5	1,571.0	1,047.8	285.6	51.2	22.6	29.2	65.4	196.2	317.2	809.4	1,433.2
Below Normal (13%)	1,647.4	1,433.8	1,199.6	735.0	243.8	96.9	107.8	190.2	304.9	524.4	1,023.0	1,608.1
Dry (24%)	1,848.5	1,825.8	1,518.3	788.7	236.1	88.0	110.8	216.2	408.0	873.5	1,387.6	1,827.7
Critical (15%)	2,032.6	2,085.8	1,797.1	941.8	417.1	266.8	318.1	593.5	916.2	1,381.0	1,744.9	2,068.3

Alternative 3

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,263.5	2,383.5	1,905.6	1,036.4	287.5	164.4	238.6	463.7	603.2	1,094.6	1,653.6	2,026.6
20%	2,029.1	2,019.2	1,843.4	846.5	144.7	101.1	148.0	328.2	527.8	950.8	1,466.8	1,897.7
30%	1,961.3	1,923.3	1,696.0	662.1	83.9	35.5	93.0	251.0	476.0	837.9	1,302.0	1,792.8
40%	1,887.4	1,875.6	1,442.8	352.8	48.3	26.9	53.0	161.4	396.4	556.5	1,075.1	1,622.3
50%	1,824.1	1,793.3	1,220.7	242.8	31.7	24.2	34.9	112.8	303.4	499.7	915.8	1,520.4
60%	1,752.5	1,700.4	788.5	95.7	27.2	22.6	24.3	69.9	242.0	330.2	873.4	1,455.8
70%	1,710.1	1,614.7	332.7	28.3	23.9	21.0	20.6	30.1	180.3	284.8	779.3	1,394.5
80%	1,636.5	1,409.1	234.3	23.5	21.3	19.8	19.5	18.8	99.5	263.0	765.0	1,355.0
90%	1,438.5	595.6	89.2	21.4	19.5	17.8	18.4	16.4	20.6	193.9	686.6	1,316.7
Long Term												
Full Simulation Period ^b	1,786.9	1,649.7	1,064.4	409.9	119.2	64.5	91.5	190.0	371.9	604.1	1,073.0	1,568.1
Water Year Types^c												
Wet (32%)	1,550.8	1,384.8	410.3	73.6	24.6	21.2	23.4	43.0	128.1	221.3	731.2	1,232.1
Above Normal (16%)	1,985.9	1,594.9	982.2	200.1	31.7	21.0	27.7	70.3	235.7	311.9	784.4	1,418.3
Below Normal (13%)	1,677.7	1,465.7	1,202.6	512.9	126.9	69.1	97.2	197.0	404.0	514.3	944.1	1,525.3
Dry (24%)	1,850.8	1,852.8	1,501.1	624.9	158.7	66.5	97.8	222.1	439.1	871.8	1,365.7	1,819.3
Critical (15%)	2,076.6	2,113.1	1,716.3	913.2	346.3	198.1	292.6	578.5	906.0	1,385.8	1,756.4	2,079.1

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	-1.5	28.5	-1.8	-235.6	-204.8	-104.8	-54.9	21.9	18.1	-91.1	-72.0	2.3
20%	39.5	45.6	-9.5	-234.1	-122.4	-14.5	-16.0	21.4	22.9	0.7	3.0	-17.4
30%	20.7	-3.0	-42.7	-178.6	-79.4	-17.2	-17.4	-27.7	63.0	4.5	-57.2	16.8
40%	3.5	22.6	-119.9	-134.5	-41.1	-8.1	-11.6	18.7	80.8	-13.9	-71.2	-56.6
50%	1.4	8.3	-4.2	-103.7	-16.7	-2.0	-1.1	21.1	57.3	11.0	-27.6	-44.3
60%	-32.5	21.4	-0.6	-77.7	-1.1	-1.0	0.0	14.3	37.5	-18.1	-17.8	-31.1
70%	-7.8	-13.4	-58.0	-4.8	-0.4	-0.9	-0.3	0.4	22.2	-30.3	-57.6	-49.3
80%	7.2	-28.2	2.4	-0.2	0.4	-0.2	-0.1	0.4	19.6	11.3	-21.8	-26.3
90%	109.5	63.5	14.4	1.2	0.0	0.0	-0.3	-0.1	1.5	0.9	-24.2	39.4
Long Term												
Full Simulation Period ^b	18.9	24.5	-31.1	-93.5	-48.9	-19.3	-8.7	2.8	34.7	-3.6	-27.7	-17.6
Water Year Types^c												
Wet (32%)	-10.0	18.3	-15.9	-18.8	-2.9	-0.1	-0.4	6.0	28.4	-5.4	-30.0	-11.5
Above Normal (16%)	69.4	23.9	-65.6	-85.5	-19.4	-1.7	-1.5	4.9	39.5	-5.2	-25.0	-14.9
Below Normal (13%)	30.3	31.9	3.0	-222.1	-116.9	-27.8	-10.6	6.7	99.1	-10.0	-78.9	-82.8
Dry (24%)	2.3	27.0	-17.2	-163.9	-77.4	-21.5	-13.0	5.9	31.2	-1.7	-21.9	-8.4
Critical (15%)	44.0	27.3	-80.8	-28.6	-70.8	-68.7	-25.4	-15.0	-10.3	4.8	11.5	10.7

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.22.6. Antioch, Monthly Chloride Concentration

Second Basis of Comparison

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,265.0	2,355.0	1,907.3	1,272.0	492.3	269.2	293.5	441.8	585.2	1,185.7	1,725.6	2,024.3
20%	1,989.6	1,973.6	1,852.9	1,080.6	267.2	115.6	164.1	306.8	504.9	950.1	1,463.9	1,915.1
30%	1,940.6	1,926.3	1,738.7	840.7	163.3	52.8	110.4	278.8	413.0	833.4	1,359.2	1,776.1
40%	1,883.9	1,853.0	1,562.7	487.3	89.4	34.9	64.6	142.7	315.6	570.4	1,146.3	1,678.9
50%	1,822.7	1,785.0	1,224.9	346.5	48.4	26.3	36.1	91.7	246.1	488.7	943.4	1,564.7
60%	1,785.1	1,679.0	789.1	173.4	28.3	23.6	24.3	55.6	204.4	348.3	891.2	1,486.9
70%	1,717.9	1,628.2	390.6	33.1	24.3	22.0	21.0	29.6	158.1	315.1	836.9	1,443.8
80%	1,629.3	1,437.3	231.9	23.7	20.9	20.0	19.6	18.4	79.9	251.7	786.8	1,381.2
90%	1,329.1	532.1	74.8	20.2	19.5	17.9	18.7	16.4	19.2	193.0	710.8	1,277.3
Long Term												
Full Simulation Period ^b	1,768.0	1,625.2	1,095.5	503.4	168.1	83.8	100.2	187.2	337.2	607.7	1,100.7	1,585.7
Water Year Types^c												
Wet (32%)	1,560.8	1,366.5	426.2	92.4	27.4	21.2	23.8	37.0	99.7	226.7	761.2	1,243.5
Above Normal (16%)	1,916.5	1,571.0	1,047.8	285.6	51.2	22.6	29.2	65.4	196.2	317.2	809.4	1,433.2
Below Normal (13%)	1,647.4	1,433.8	1,199.6	735.0	243.8	96.9	107.8	190.2	304.9	524.4	1,023.0	1,608.1
Dry (24%)	1,848.5	1,825.8	1,518.3	788.7	236.1	88.0	110.8	216.2	408.0	873.5	1,387.6	1,827.7
Critical (15%)	2,032.6	2,085.8	1,797.1	941.8	417.1	266.8	318.1	593.5	916.2	1,381.0	1,744.9	2,068.3

Alternative 5

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	2,318.4	2,329.0	1,880.5	894.9	283.0	171.2	180.5	305.6	542.6	1,168.9	1,645.8	2,019.5
20%	2,067.2	1,960.8	1,453.7	728.0	142.6	98.5	96.5	216.1	474.0	930.8	1,405.6	1,866.4
30%	1,996.2	1,845.5	867.0	525.0	85.1	39.5	51.0	157.7	436.7	824.4	1,346.1	1,814.0
40%	1,889.7	1,458.6	711.9	300.4	51.7	27.3	30.8	79.3	361.9	597.7	1,066.2	1,659.4
50%	1,662.8	554.9	572.7	243.2	32.5	24.2	25.5	45.9	268.8	482.3	930.9	1,386.6
60%	504.4	471.1	466.9	72.3	27.5	22.7	23.2	30.6	226.5	322.3	875.2	591.4
70%	175.4	170.6	162.5	27.2	23.7	21.3	21.8	23.7	141.9	281.2	809.1	355.0
80%	160.9	143.3	60.8	23.2	21.6	20.0	20.8	21.4	66.5	251.3	737.0	325.4
90%	136.6	126.3	22.5	20.2	19.8	18.1	19.9	18.0	19.4	189.6	691.9	297.5
Long Term												
Full Simulation Period ^b	1,190.8	1,034.6	742.1	365.7	119.4	64.8	68.8	128.1	326.1	592.7	1,063.4	1,138.9
Water Year Types^c												
Wet (32%)	788.0	578.0	200.3	62.0	25.3	21.1	21.4	25.4	109.7	210.2	740.5	304.0
Above Normal (16%)	1,556.0	1,087.3	616.5	159.7	33.0	22.1	23.1	36.9	224.1	305.7	769.6	590.6
Below Normal (13%)	812.6	762.8	728.3	397.2	116.0	66.4	62.7	116.2	355.8	507.7	944.0	1,562.5
Dry (24%)	1,285.7	1,223.1	1,071.6	563.7	163.0	67.4	66.8	147.9	391.0	884.2	1,347.1	1,795.2
Critical (15%)	1,855.9	1,901.7	1,515.8	888.2	347.6	199.8	230.0	426.9	769.9	1,324.0	1,717.6	2,060.0

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Chloride Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	53.4	-26.0	-26.9	-377.1	-209.3	-98.0	-113.0	-136.2	-42.6	-16.8	-79.8	-4.8
20%	77.7	-12.7	-399.2	-352.6	-124.6	-17.2	-67.5	-90.8	-30.9	-19.3	-58.3	-48.6
30%	55.5	-80.8	-871.7	-315.7	-78.2	-13.3	-59.4	-121.1	23.6	-9.0	-13.1	37.9
40%	5.7	-394.4	-850.8	-186.9	-37.7	-7.6	-33.9	-63.3	46.3	27.3	-80.1	-19.6
50%	-159.8	-1,230.1	-652.2	-103.3	-15.9	-2.1	-10.6	-45.8	22.7	-6.5	-12.5	-178.1
60%	-1,280.7	-1,207.9	-322.2	-101.1	-0.8	-0.9	-1.2	-25.1	22.0	-26.0	-16.0	-895.5
70%	-1,542.5	-1,457.6	-228.1	-5.9	-0.6	-0.7	0.8	-5.9	-16.1	-33.9	-27.8	-1,088.7
80%	-1,468.4	-1,294.0	-171.1	-0.5	0.7	0.0	1.3	3.1	-13.4	-0.4	-49.7	-1,055.9
90%	-1,192.4	-405.8	-52.2	-0.1	0.3	0.2	1.2	1.6	0.2	-3.5	-18.9	-979.8
Long Term												
Full Simulation Period ^b	-577.3	-590.6	-353.3	-137.6	-48.7	-19.1	-31.4	-59.1	-11.1	-15.0	-37.3	-446.8
Water Year Types^c												
Wet (32%)	-772.7	-788.4	-225.9	-30.4	-2.1	-0.2	-2.4	-11.5	10.0	-16.5	-20.7	-939.5
Above Normal (16%)	-360.5	-483.7	-431.3	-125.9	-18.2	-0.5	-6.1	-28.5	27.9	-11.5	-39.8	-842.6
Below Normal (13%)	-834.8	-671.0	-471.3	-337.8	-127.8	-30.6	-45.1	-74.0	51.0	-16.6	-79.1	-45.6
Dry (24%)	-562.8	-602.6	-446.7	-225.0	-73.1	-20.6	-44.0	-68.3	-17.0	10.7	-40.5	-32.5
Critical (15%)	-176.7	-184.1	-281.3	-53.5	-69.5	-67.1	-88.1	-166.6	-146.3	-57.0	-27.3	-8.4

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1
2

B.23. Jones Pumping Plant Bromide Concentration

Table 6E.B.23.1. Jones Pumping Plant, Monthly Bromide Concentration

No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.50	0.55	0.58	0.55	0.44	0.28	0.21	0.19	0.16	0.25	0.36	0.43
20%	0.47	0.46	0.52	0.51	0.29	0.23	0.18	0.18	0.14	0.19	0.32	0.41
30%	0.45	0.41	0.48	0.46	0.24	0.21	0.15	0.16	0.13	0.17	0.29	0.37
40%	0.42	0.39	0.43	0.42	0.23	0.19	0.14	0.14	0.12	0.13	0.25	0.35
50%	0.39	0.34	0.32	0.39	0.21	0.18	0.11	0.12	0.12	0.12	0.23	0.33
60%	0.20	0.16	0.17	0.26	0.18	0.14	0.10	0.11	0.12	0.11	0.20	0.31
70%	0.12	0.11	0.15	0.20	0.16	0.11	0.09	0.11	0.11	0.10	0.18	0.29
80%	0.11	0.10	0.14	0.17	0.13	0.09	0.08	0.09	0.11	0.10	0.17	0.27
90%	0.11	0.10	0.13	0.14	0.09	0.08	0.06	0.05	0.10	0.09	0.09	0.25
Long Term												
Full Simulation Period ^b	0.30	0.30	0.33	0.34	0.23	0.17	0.13	0.13	0.12	0.15	0.24	0.33
Water Year Types ^c												
Wet (32%)	0.25	0.22	0.22	0.19	0.13	0.10	0.07	0.08	0.10	0.10	0.14	0.26
Above Normal (16%)	0.38	0.36	0.34	0.33	0.19	0.14	0.10	0.11	0.12	0.10	0.18	0.26
Below Normal (13%)	0.25	0.22	0.28	0.37	0.23	0.18	0.13	0.14	0.12	0.14	0.23	0.38
Dry (24%)	0.30	0.31	0.38	0.44	0.29	0.21	0.16	0.16	0.13	0.19	0.32	0.37
Critical (15%)	0.41	0.44	0.49	0.50	0.38	0.28	0.21	0.19	0.15	0.25	0.36	0.43

Alternative 1												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.51	0.56	0.58	0.57	0.50	0.31	0.17	0.15	0.15	0.23	0.33	0.44
20%	0.49	0.48	0.53	0.52	0.44	0.21	0.16	0.13	0.14	0.17	0.29	0.41
30%	0.47	0.45	0.51	0.49	0.29	0.18	0.13	0.12	0.12	0.15	0.27	0.39
40%	0.46	0.43	0.48	0.48	0.20	0.17	0.12	0.11	0.11	0.12	0.25	0.36
50%	0.45	0.41	0.47	0.45	0.18	0.15	0.11	0.10	0.11	0.11	0.22	0.36
60%	0.43	0.39	0.45	0.26	0.16	0.13	0.09	0.09	0.10	0.10	0.19	0.35
70%	0.42	0.37	0.41	0.17	0.14	0.11	0.09	0.09	0.10	0.10	0.18	0.34
80%	0.40	0.35	0.33	0.15	0.12	0.09	0.08	0.08	0.10	0.09	0.16	0.32
90%	0.34	0.28	0.14	0.14	0.09	0.08	0.06	0.05	0.08	0.08	0.10	0.28
Long Term												
Full Simulation Period ^b	0.43	0.41	0.43	0.36	0.25	0.17	0.12	0.10	0.12	0.14	0.22	0.35
Water Year Types ^c												
Wet (32%)	0.39	0.36	0.33	0.19	0.12	0.10	0.07	0.07	0.10	0.10	0.14	0.29
Above Normal (16%)	0.47	0.43	0.41	0.35	0.19	0.13	0.09	0.09	0.11	0.10	0.17	0.36
Below Normal (13%)	0.40	0.37	0.42	0.41	0.28	0.21	0.12	0.11	0.10	0.14	0.23	0.36
Dry (24%)	0.44	0.42	0.49	0.45	0.33	0.20	0.13	0.12	0.12	0.15	0.28	0.38
Critical (15%)	0.49	0.50	0.55	0.52	0.42	0.28	0.21	0.15	0.21	0.24	0.35	0.44

Alternative 1 minus No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.02	0.00	0.00	0.02	0.07	0.03	-0.04	-0.04	0.00	-0.02	-0.03	0.01
20%	0.02	0.02	0.01	0.01	0.15	-0.02	-0.03	-0.05	0.00	-0.02	-0.03	0.00
30%	0.02	0.03	0.03	0.04	0.05	-0.03	-0.02	-0.04	-0.01	-0.03	-0.02	0.01
40%	0.04	0.03	0.06	0.05	-0.03	-0.03	-0.02	-0.04	-0.01	-0.01	0.00	0.01
50%	0.06	0.07	0.15	0.06	-0.02	-0.02	-0.01	-0.02	-0.01	-0.01	-0.01	0.03
60%	0.23	0.24	0.28	0.00	-0.02	0.00	0.00	-0.02	-0.01	-0.01	0.00	0.04
70%	0.30	0.26	0.26	-0.03	-0.02	0.00	0.00	-0.02	-0.01	-0.01	0.00	0.04
80%	0.29	0.25	0.20	-0.02	-0.01	0.00	0.00	-0.01	-0.01	0.00	-0.01	0.05
90%	0.23	0.19	0.00	-0.01	0.00	0.00	0.00	0.00	-0.01	0.00	0.01	0.03
Long Term												
Full Simulation Period ^b	0.13	0.11	0.10	0.01	0.02	0.00	-0.01	-0.02	0.00	-0.01	-0.01	0.02
Water Year Types ^c												
Wet (32%)	0.14	0.15	0.11	0.00	-0.01	0.00	0.00	-0.01	-0.01	0.00	-0.01	0.02
Above Normal (16%)	0.09	0.07	0.07	0.01	-0.01	-0.01	-0.01	-0.02	-0.01	-0.01	0.00	0.10
Below Normal (13%)	0.15	0.15	0.14	0.04	0.05	0.04	-0.01	-0.03	-0.02	0.00	0.00	-0.02
Dry (24%)	0.15	0.11	0.11	0.01	0.03	-0.01	-0.02	-0.04	-0.01	-0.04	-0.03	0.01
Critical (15%)	0.08	0.06	0.05	0.02	0.04	0.00	0.00	-0.04	0.06	0.00	-0.01	0.01

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.23.2. Jones Pumping Plant, Monthly Bromide Concentration

No Action Alternative		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a													
10%		0.50	0.55	0.58	0.55	0.44	0.28	0.21	0.19	0.16	0.25	0.36	0.43
20%		0.47	0.46	0.52	0.51	0.29	0.23	0.18	0.18	0.14	0.19	0.32	0.41
30%		0.45	0.41	0.48	0.46	0.24	0.21	0.15	0.16	0.13	0.17	0.29	0.37
40%		0.42	0.39	0.43	0.42	0.23	0.19	0.14	0.14	0.12	0.13	0.25	0.35
50%		0.39	0.34	0.32	0.39	0.21	0.18	0.11	0.12	0.12	0.12	0.23	0.33
60%		0.20	0.16	0.17	0.26	0.18	0.14	0.10	0.11	0.12	0.11	0.20	0.31
70%		0.12	0.11	0.15	0.20	0.16	0.11	0.09	0.11	0.11	0.10	0.18	0.29
80%		0.11	0.10	0.14	0.17	0.13	0.09	0.08	0.09	0.11	0.10	0.17	0.27
90%		0.11	0.10	0.13	0.14	0.09	0.08	0.06	0.05	0.10	0.09	0.09	0.25
Long Term													
Full Simulation Period ^b		0.30	0.30	0.33	0.34	0.23	0.17	0.13	0.13	0.12	0.15	0.24	0.33
Water Year Types^c													
Wet (32%)		0.25	0.22	0.22	0.19	0.13	0.10	0.07	0.08	0.10	0.10	0.14	0.26
Above Normal (16%)		0.38	0.36	0.34	0.33	0.19	0.14	0.10	0.11	0.12	0.10	0.18	0.26
Below Normal (13%)		0.25	0.22	0.28	0.37	0.23	0.18	0.13	0.14	0.12	0.14	0.23	0.38
Dry (24%)		0.30	0.31	0.38	0.44	0.29	0.21	0.16	0.16	0.13	0.19	0.32	0.37
Critical (15%)		0.41	0.44	0.49	0.50	0.38	0.28	0.21	0.19	0.15	0.25	0.36	0.43

Alternative 3		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a													
10%		0.51	0.55	0.58	0.56	0.47	0.27	0.21	0.19	0.15	0.26	0.37	0.44
20%		0.49	0.48	0.53	0.53	0.29	0.23	0.17	0.17	0.12	0.19	0.31	0.41
30%		0.48	0.44	0.50	0.51	0.24	0.21	0.15	0.15	0.12	0.17	0.28	0.39
40%		0.46	0.42	0.49	0.48	0.22	0.19	0.12	0.13	0.11	0.13	0.25	0.37
50%		0.44	0.41	0.47	0.46	0.20	0.16	0.11	0.11	0.11	0.12	0.23	0.36
60%		0.43	0.40	0.45	0.25	0.17	0.14	0.09	0.10	0.10	0.11	0.19	0.35
70%		0.41	0.39	0.41	0.20	0.15	0.11	0.09	0.10	0.10	0.10	0.18	0.33
80%		0.40	0.36	0.33	0.16	0.12	0.09	0.07	0.09	0.09	0.10	0.11	0.32
90%		0.34	0.30	0.14	0.14	0.09	0.08	0.06	0.05	0.08	0.09	0.09	0.26
Long Term													
Full Simulation Period ^b		0.43	0.41	0.43	0.37	0.23	0.17	0.12	0.12	0.12	0.15	0.23	0.35
Water Year Types^c													
Wet (32%)		0.38	0.37	0.34	0.21	0.12	0.10	0.07	0.07	0.09	0.10	0.13	0.27
Above Normal (16%)		0.48	0.45	0.42	0.37	0.20	0.14	0.10	0.10	0.10	0.10	0.17	0.36
Below Normal (13%)		0.40	0.36	0.43	0.42	0.25	0.17	0.13	0.14	0.10	0.15	0.24	0.39
Dry (24%)		0.44	0.43	0.49	0.46	0.28	0.21	0.15	0.15	0.11	0.18	0.30	0.38
Critical (15%)		0.49	0.50	0.53	0.49	0.40	0.31	0.21	0.19	0.20	0.25	0.36	0.44

Alternative 3 minus No Action Alternative		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a													
10%		0.02	0.00	0.00	0.01	0.03	0.00	0.00	0.01	-0.01	0.01	0.01	0.01
20%		0.02	0.02	0.01	0.02	0.00	0.00	-0.01	-0.01	-0.01	0.00	0.00	0.01
30%		0.03	0.03	0.02	0.05	0.00	0.00	0.00	-0.01	-0.01	0.00	-0.01	0.02
40%		0.04	0.03	0.06	0.06	-0.01	0.00	-0.02	-0.01	-0.01	0.01	0.00	0.02
50%		0.05	0.07	0.15	0.06	0.00	-0.01	0.00	-0.01	-0.01	0.00	0.00	0.03
60%		0.22	0.24	0.28	-0.01	-0.01	0.01	0.00	-0.01	-0.01	0.00	0.00	0.04
70%		0.30	0.27	0.27	0.01	-0.01	0.00	0.00	-0.01	-0.01	0.00	0.00	0.04
80%		0.29	0.26	0.19	-0.01	-0.01	0.00	0.00	0.00	-0.01	0.00	-0.06	0.05
90%		0.23	0.20	0.01	-0.01	-0.01	0.00	0.00	0.00	-0.02	0.00	0.00	0.01
Long Term													
Full Simulation Period ^b		0.13	0.12	0.10	0.02	0.00	0.00	0.00	0.00	-0.01	0.00	-0.01	0.02
Water Year Types^c													
Wet (32%)		0.14	0.15	0.12	0.02	-0.01	0.00	0.00	-0.01	-0.01	0.00	-0.02	0.01
Above Normal (16%)		0.10	0.08	0.08	0.03	0.01	-0.01	-0.01	-0.01	-0.02	0.00	0.00	0.10
Below Normal (13%)		0.15	0.14	0.14	0.05	0.02	-0.01	0.00	0.00	-0.02	0.01	0.01	0.01
Dry (24%)		0.14	0.12	0.11	0.02	-0.01	0.00	0.00	0.00	-0.02	0.00	-0.02	0.01
Critical (15%)		0.08	0.06	0.03	-0.01	0.02	0.03	0.00	0.00	0.05	0.00	0.00	0.01

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.23.3. Jones Pumping Plant, Monthly Bromide Concentration

No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.50	0.55	0.58	0.55	0.44	0.28	0.21	0.19	0.16	0.25	0.36	0.43
20%	0.47	0.46	0.52	0.51	0.29	0.23	0.18	0.18	0.14	0.19	0.32	0.41
30%	0.45	0.41	0.48	0.46	0.24	0.21	0.15	0.16	0.13	0.17	0.29	0.37
40%	0.42	0.39	0.43	0.42	0.23	0.19	0.14	0.14	0.12	0.13	0.25	0.35
50%	0.39	0.34	0.32	0.39	0.21	0.18	0.11	0.12	0.12	0.12	0.23	0.33
60%	0.20	0.16	0.17	0.26	0.18	0.14	0.10	0.11	0.12	0.11	0.20	0.31
70%	0.12	0.11	0.15	0.20	0.16	0.11	0.09	0.11	0.11	0.10	0.18	0.29
80%	0.11	0.10	0.14	0.17	0.13	0.09	0.08	0.09	0.11	0.10	0.17	0.27
90%	0.11	0.10	0.13	0.14	0.09	0.08	0.06	0.05	0.10	0.09	0.09	0.25
Long Term												
Full Simulation Period ^b	0.30	0.30	0.33	0.34	0.23	0.17	0.13	0.13	0.12	0.15	0.24	0.33
Water Year Types ^c												
Wet (32%)	0.25	0.22	0.22	0.19	0.13	0.10	0.07	0.08	0.10	0.10	0.14	0.26
Above Normal (16%)	0.38	0.36	0.34	0.33	0.19	0.14	0.10	0.11	0.12	0.10	0.18	0.26
Below Normal (13%)	0.25	0.22	0.28	0.37	0.23	0.18	0.13	0.14	0.12	0.14	0.23	0.38
Dry (24%)	0.30	0.31	0.38	0.44	0.29	0.21	0.16	0.16	0.13	0.19	0.32	0.37
Critical (15%)	0.41	0.44	0.49	0.50	0.38	0.28	0.21	0.19	0.15	0.25	0.36	0.43

Alternative 5												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.52	0.55	0.58	0.55	0.46	0.28	0.21	0.18	0.18	0.24	0.37	0.43
20%	0.47	0.48	0.52	0.51	0.30	0.23	0.18	0.18	0.15	0.21	0.33	0.41
30%	0.44	0.42	0.49	0.46	0.24	0.21	0.15	0.16	0.14	0.18	0.30	0.39
40%	0.43	0.40	0.43	0.43	0.23	0.19	0.13	0.14	0.13	0.13	0.25	0.36
50%	0.39	0.35	0.32	0.39	0.21	0.18	0.11	0.12	0.12	0.12	0.23	0.33
60%	0.21	0.14	0.17	0.25	0.18	0.14	0.10	0.11	0.12	0.11	0.20	0.31
70%	0.12	0.11	0.15	0.20	0.16	0.11	0.09	0.11	0.11	0.10	0.18	0.29
80%	0.11	0.10	0.14	0.17	0.13	0.09	0.08	0.09	0.11	0.10	0.17	0.27
90%	0.11	0.10	0.13	0.14	0.09	0.08	0.06	0.05	0.10	0.09	0.10	0.25
Long Term												
Full Simulation Period ^b	0.31	0.30	0.33	0.35	0.24	0.17	0.12	0.13	0.13	0.15	0.24	0.33
Water Year Types ^c												
Wet (32%)	0.25	0.22	0.22	0.19	0.13	0.10	0.07	0.08	0.10	0.10	0.15	0.26
Above Normal (16%)	0.39	0.36	0.33	0.33	0.19	0.14	0.10	0.11	0.12	0.10	0.18	0.26
Below Normal (13%)	0.24	0.22	0.28	0.37	0.23	0.18	0.13	0.14	0.13	0.14	0.23	0.38
Dry (24%)	0.30	0.31	0.38	0.45	0.29	0.21	0.16	0.16	0.14	0.20	0.33	0.38
Critical (15%)	0.41	0.44	0.49	0.50	0.43	0.28	0.21	0.18	0.17	0.24	0.36	0.43

Alternative 5 minus No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.02	0.00	0.00	0.00	0.02	0.00	0.00	-0.01	0.02	0.00	0.01	0.00
20%	0.00	0.02	-0.01	0.01	0.01	0.00	0.00	0.00	0.01	0.02	0.01	0.00
30%	-0.01	0.00	0.01	0.00	0.00	0.00	-0.01	-0.01	0.01	0.01	0.01	0.01
40%	0.01	0.00	0.00	0.00	0.00	0.00	-0.01	-0.01	0.01	0.00	0.00	0.01
50%	0.00	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
60%	0.01	-0.02	0.00	-0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
70%	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
80%	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90%	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.00
Long Term												
Full Simulation Period ^b	0.00	0.00	0.00	0.00	0.01	0.00	0.00	0.00	0.01	0.00	0.01	0.00
Water Year Types ^c												
Wet (32%)	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.00
Above Normal (16%)	0.01	0.00	-0.02	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Below Normal (13%)	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Dry (24%)	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.01	0.01	0.01
Critical (15%)	0.00	0.00	0.00	0.00	0.05	0.00	0.00	-0.01	0.02	-0.01	0.00	0.01

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.23.4. Jones Pumping Plant, Monthly Bromide Concentration

Second Basis of Comparison

Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.51	0.56	0.58	0.57	0.50	0.31	0.17	0.15	0.15	0.23	0.33	0.44
20%	0.49	0.48	0.53	0.52	0.44	0.21	0.16	0.13	0.14	0.17	0.29	0.41
30%	0.47	0.45	0.51	0.49	0.29	0.18	0.13	0.12	0.12	0.15	0.27	0.39
40%	0.46	0.43	0.48	0.48	0.20	0.17	0.12	0.11	0.11	0.12	0.25	0.36
50%	0.45	0.41	0.47	0.45	0.18	0.15	0.11	0.10	0.11	0.11	0.22	0.36
60%	0.43	0.39	0.45	0.26	0.16	0.13	0.09	0.09	0.10	0.10	0.19	0.35
70%	0.42	0.37	0.41	0.17	0.14	0.11	0.09	0.09	0.10	0.10	0.18	0.34
80%	0.40	0.35	0.33	0.15	0.12	0.09	0.08	0.08	0.10	0.09	0.16	0.32
90%	0.34	0.28	0.14	0.14	0.09	0.08	0.06	0.05	0.08	0.08	0.10	0.28
Long Term												
Full Simulation Period ^b	0.43	0.41	0.43	0.36	0.25	0.17	0.12	0.10	0.12	0.14	0.22	0.35
Water Year Types ^c												
Wet (32%)	0.39	0.36	0.33	0.19	0.12	0.10	0.07	0.07	0.10	0.10	0.14	0.29
Above Normal (16%)	0.47	0.43	0.41	0.35	0.19	0.13	0.09	0.09	0.11	0.10	0.17	0.36
Below Normal (13%)	0.40	0.37	0.42	0.41	0.28	0.21	0.12	0.11	0.10	0.14	0.23	0.36
Dry (24%)	0.44	0.42	0.49	0.45	0.33	0.20	0.13	0.12	0.12	0.15	0.28	0.38
Critical (15%)	0.49	0.50	0.55	0.52	0.42	0.28	0.21	0.15	0.21	0.24	0.35	0.44

No Action Alternative

Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.50	0.55	0.58	0.55	0.44	0.28	0.21	0.19	0.16	0.25	0.36	0.43
20%	0.47	0.46	0.52	0.51	0.29	0.23	0.18	0.18	0.14	0.19	0.32	0.41
30%	0.45	0.41	0.48	0.46	0.24	0.21	0.15	0.16	0.13	0.17	0.29	0.37
40%	0.42	0.39	0.43	0.42	0.23	0.19	0.14	0.14	0.12	0.13	0.25	0.35
50%	0.39	0.34	0.32	0.39	0.21	0.18	0.11	0.12	0.12	0.12	0.23	0.33
60%	0.20	0.16	0.17	0.26	0.18	0.14	0.10	0.11	0.12	0.11	0.20	0.31
70%	0.12	0.11	0.15	0.20	0.16	0.11	0.09	0.11	0.11	0.10	0.18	0.29
80%	0.11	0.10	0.14	0.17	0.13	0.09	0.08	0.09	0.11	0.10	0.17	0.27
90%	0.11	0.10	0.13	0.14	0.09	0.08	0.06	0.05	0.10	0.09	0.09	0.25
Long Term												
Full Simulation Period ^b	0.30	0.30	0.33	0.34	0.23	0.17	0.13	0.13	0.12	0.15	0.24	0.33
Water Year Types ^c												
Wet (32%)	0.25	0.22	0.22	0.19	0.13	0.10	0.07	0.08	0.10	0.10	0.14	0.26
Above Normal (16%)	0.38	0.36	0.34	0.33	0.19	0.14	0.10	0.11	0.12	0.10	0.18	0.26
Below Normal (13%)	0.25	0.22	0.28	0.37	0.23	0.18	0.13	0.14	0.12	0.14	0.23	0.38
Dry (24%)	0.30	0.31	0.38	0.44	0.29	0.21	0.16	0.16	0.13	0.19	0.32	0.37
Critical (15%)	0.41	0.44	0.49	0.50	0.38	0.28	0.21	0.19	0.15	0.25	0.36	0.43

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.02	0.00	0.00	-0.02	-0.07	-0.03	0.04	0.04	0.00	0.02	0.03	-0.01
20%	-0.02	-0.02	-0.01	-0.01	-0.15	0.02	0.03	0.05	0.00	0.02	0.03	0.00
30%	-0.02	-0.03	-0.03	-0.04	-0.05	0.03	0.02	0.04	0.01	0.03	0.02	-0.01
40%	-0.04	-0.03	-0.06	-0.05	0.03	0.03	0.02	0.04	0.01	0.01	0.00	-0.01
50%	-0.06	-0.07	-0.15	-0.06	0.02	0.02	0.01	0.02	0.01	0.01	0.01	-0.03
60%	-0.23	-0.24	-0.28	0.00	0.02	0.00	0.00	0.02	0.01	0.01	0.00	-0.04
70%	-0.30	-0.26	-0.26	0.03	0.02	0.00	0.00	0.02	0.01	0.01	0.00	-0.04
80%	-0.29	-0.25	-0.20	0.02	0.01	0.00	0.00	0.01	0.01	0.00	0.01	-0.05
90%	-0.23	-0.19	0.00	0.01	0.00	0.00	0.00	0.00	0.01	0.00	-0.01	-0.03
Long Term												
Full Simulation Period ^b	-0.13	-0.11	-0.10	-0.01	-0.02	0.00	0.01	0.02	0.00	0.01	0.01	-0.02
Water Year Types ^c												
Wet (32%)	-0.14	-0.15	-0.11	0.00	0.01	0.00	0.00	0.01	0.01	0.00	0.01	-0.02
Above Normal (16%)	-0.09	-0.07	-0.07	-0.01	0.01	0.01	0.01	0.02	0.01	0.01	0.00	-0.10
Below Normal (13%)	-0.15	-0.15	-0.14	-0.04	-0.05	-0.04	0.01	0.03	0.02	0.00	0.00	0.02
Dry (24%)	-0.15	-0.11	-0.11	-0.01	-0.03	0.01	0.02	0.04	0.01	0.04	0.03	-0.01
Critical (15%)	-0.08	-0.06	-0.05	-0.02	-0.04	0.00	0.00	0.04	-0.06	0.00	0.01	-0.01

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.23.5. Jones Pumping Plant, Monthly Bromide Concentration

Second Basis of Comparison

Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.51	0.56	0.58	0.57	0.50	0.31	0.17	0.15	0.15	0.23	0.33	0.44
20%	0.49	0.48	0.53	0.52	0.44	0.21	0.16	0.13	0.14	0.17	0.29	0.41
30%	0.47	0.45	0.51	0.49	0.29	0.18	0.13	0.12	0.12	0.15	0.27	0.39
40%	0.46	0.43	0.48	0.48	0.20	0.17	0.12	0.11	0.11	0.12	0.25	0.36
50%	0.45	0.41	0.47	0.45	0.18	0.15	0.11	0.10	0.11	0.11	0.22	0.36
60%	0.43	0.39	0.45	0.26	0.16	0.13	0.09	0.09	0.10	0.10	0.19	0.35
70%	0.42	0.37	0.41	0.17	0.14	0.11	0.09	0.09	0.10	0.10	0.18	0.34
80%	0.40	0.35	0.33	0.15	0.12	0.09	0.08	0.08	0.10	0.09	0.16	0.32
90%	0.34	0.28	0.14	0.14	0.09	0.08	0.06	0.05	0.08	0.08	0.10	0.28
Long Term												
Full Simulation Period ^b	0.43	0.41	0.43	0.36	0.25	0.17	0.12	0.10	0.12	0.14	0.22	0.35
Water Year Types ^c												
Wet (32%)	0.39	0.36	0.33	0.19	0.12	0.10	0.07	0.07	0.10	0.10	0.14	0.29
Above Normal (16%)	0.47	0.43	0.41	0.35	0.19	0.13	0.09	0.09	0.11	0.10	0.17	0.36
Below Normal (13%)	0.40	0.37	0.42	0.41	0.28	0.21	0.12	0.11	0.10	0.14	0.23	0.36
Dry (24%)	0.44	0.42	0.49	0.45	0.33	0.20	0.13	0.12	0.12	0.15	0.28	0.38
Critical (15%)	0.49	0.50	0.55	0.52	0.42	0.28	0.21	0.15	0.21	0.24	0.35	0.44

Alternative 3

Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.51	0.55	0.58	0.56	0.47	0.27	0.21	0.19	0.15	0.26	0.37	0.44
20%	0.49	0.48	0.53	0.53	0.29	0.23	0.17	0.17	0.12	0.19	0.31	0.41
30%	0.48	0.44	0.50	0.51	0.24	0.21	0.15	0.15	0.12	0.17	0.28	0.39
40%	0.46	0.42	0.49	0.48	0.22	0.19	0.12	0.13	0.11	0.13	0.25	0.37
50%	0.44	0.41	0.47	0.46	0.20	0.16	0.11	0.11	0.11	0.12	0.23	0.36
60%	0.43	0.40	0.45	0.25	0.17	0.14	0.09	0.10	0.10	0.11	0.19	0.35
70%	0.41	0.39	0.41	0.20	0.15	0.11	0.09	0.10	0.10	0.10	0.18	0.33
80%	0.40	0.36	0.33	0.16	0.12	0.09	0.07	0.09	0.09	0.10	0.11	0.32
90%	0.34	0.30	0.14	0.14	0.09	0.08	0.06	0.05	0.08	0.09	0.09	0.26
Long Term												
Full Simulation Period ^b	0.43	0.41	0.43	0.37	0.23	0.17	0.12	0.12	0.12	0.15	0.23	0.35
Water Year Types ^c												
Wet (32%)	0.38	0.37	0.34	0.21	0.12	0.10	0.07	0.07	0.09	0.10	0.13	0.27
Above Normal (16%)	0.48	0.45	0.42	0.37	0.20	0.14	0.10	0.10	0.10	0.10	0.17	0.36
Below Normal (13%)	0.40	0.36	0.43	0.42	0.25	0.17	0.13	0.14	0.10	0.15	0.24	0.39
Dry (24%)	0.44	0.43	0.49	0.46	0.28	0.21	0.15	0.15	0.11	0.18	0.30	0.38
Critical (15%)	0.49	0.50	0.53	0.49	0.40	0.31	0.21	0.19	0.20	0.25	0.36	0.44

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.00	0.00	0.00	-0.01	-0.04	-0.04	0.04	0.05	0.00	0.03	0.04	0.00
20%	0.00	0.00	0.00	0.02	-0.15	0.02	0.02	0.04	-0.01	0.02	0.03	0.00
30%	0.00	-0.01	0.00	0.01	-0.05	0.03	0.02	0.03	-0.01	0.03	0.01	0.01
40%	0.00	0.00	0.01	0.01	0.02	0.02	0.01	0.03	0.00	0.01	0.00	0.01
50%	-0.01	0.00	0.00	0.00	0.02	0.01	0.00	0.01	0.00	0.01	0.01	0.00
60%	0.00	0.01	0.00	-0.01	0.01	0.01	0.00	0.01	0.00	0.01	0.00	0.00
70%	0.00	0.01	0.00	0.04	0.01	0.00	0.00	0.01	0.00	0.01	0.00	0.00
80%	0.00	0.00	-0.01	0.01	0.00	0.00	0.00	0.00	0.00	0.00	-0.05	0.00
90%	0.00	0.01	0.01	0.00	-0.01	0.00	0.00	0.00	0.00	0.00	-0.01	-0.01
Long Term												
Full Simulation Period ^b	0.00	0.01	0.00	0.01	-0.02	0.00	0.01	0.02	-0.01	0.01	0.00	0.00
Water Year Types ^c												
Wet (32%)	0.00	0.01	0.01	0.02	0.00	0.00	0.00	0.00	0.00	0.00	-0.01	-0.01
Above Normal (16%)	0.01	0.02	0.01	0.02	0.01	0.01	0.00	0.01	-0.01	0.00	0.00	0.00
Below Normal (13%)	0.00	0.00	0.00	0.01	-0.03	-0.04	0.01	0.03	0.00	0.01	0.01	0.03
Dry (24%)	-0.01	0.01	0.00	0.01	-0.05	0.01	0.02	0.03	-0.01	0.03	0.02	0.00
Critical (15%)	0.00	0.00	-0.02	-0.03	-0.03	0.03	0.00	0.04	-0.01	0.01	0.01	0.00

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.23.6. Jones Pumping Plant, Monthly Bromide Concentration

Second Basis of Comparison		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		0.51	0.56	0.58	0.57	0.50	0.31	0.17	0.15	0.15	0.23	0.33	0.44
20%		0.49	0.48	0.53	0.52	0.44	0.21	0.16	0.13	0.14	0.17	0.29	0.41
30%		0.47	0.45	0.51	0.49	0.29	0.18	0.13	0.12	0.12	0.15	0.27	0.39
40%		0.46	0.43	0.48	0.48	0.20	0.17	0.12	0.11	0.11	0.12	0.25	0.36
50%		0.45	0.41	0.47	0.45	0.18	0.15	0.11	0.10	0.11	0.11	0.22	0.36
60%		0.43	0.39	0.45	0.26	0.16	0.13	0.09	0.09	0.10	0.10	0.19	0.35
70%		0.42	0.37	0.41	0.17	0.14	0.11	0.09	0.09	0.10	0.10	0.18	0.34
80%		0.40	0.35	0.33	0.15	0.12	0.09	0.08	0.08	0.10	0.09	0.16	0.32
90%		0.34	0.28	0.14	0.14	0.09	0.08	0.06	0.05	0.08	0.08	0.10	0.28
Long Term													
Full Simulation Period ^b		0.43	0.41	0.43	0.36	0.25	0.17	0.12	0.10	0.12	0.14	0.22	0.35
Water Year Types ^c													
Wet (32%)		0.39	0.36	0.33	0.19	0.12	0.10	0.07	0.07	0.10	0.10	0.14	0.29
Above Normal (16%)		0.47	0.43	0.41	0.35	0.19	0.13	0.09	0.09	0.11	0.10	0.17	0.36
Below Normal (13%)		0.40	0.37	0.42	0.41	0.28	0.21	0.12	0.11	0.10	0.14	0.23	0.36
Dry (24%)		0.44	0.42	0.49	0.45	0.33	0.20	0.13	0.12	0.12	0.15	0.28	0.38
Critical (15%)		0.49	0.50	0.55	0.52	0.42	0.28	0.21	0.15	0.21	0.24	0.35	0.44

Alternative 5

Alternative 5		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		0.52	0.55	0.58	0.55	0.46	0.28	0.21	0.18	0.18	0.24	0.37	0.43
20%		0.47	0.48	0.52	0.51	0.30	0.23	0.18	0.18	0.15	0.21	0.33	0.41
30%		0.44	0.42	0.49	0.46	0.24	0.21	0.15	0.16	0.14	0.18	0.30	0.39
40%		0.43	0.40	0.43	0.43	0.23	0.19	0.13	0.14	0.13	0.13	0.25	0.36
50%		0.39	0.35	0.32	0.39	0.21	0.18	0.11	0.12	0.12	0.12	0.23	0.33
60%		0.21	0.14	0.17	0.25	0.18	0.14	0.10	0.11	0.12	0.11	0.20	0.31
70%		0.12	0.11	0.15	0.20	0.16	0.11	0.09	0.11	0.11	0.10	0.18	0.29
80%		0.11	0.10	0.14	0.17	0.13	0.09	0.08	0.09	0.11	0.10	0.17	0.27
90%		0.11	0.10	0.13	0.14	0.09	0.08	0.06	0.05	0.10	0.09	0.10	0.25
Long Term													
Full Simulation Period ^b		0.31	0.30	0.33	0.35	0.24	0.17	0.12	0.13	0.13	0.15	0.24	0.33
Water Year Types ^c													
Wet (32%)		0.25	0.22	0.22	0.19	0.13	0.10	0.07	0.08	0.10	0.10	0.15	0.26
Above Normal (16%)		0.39	0.36	0.33	0.33	0.19	0.14	0.10	0.11	0.12	0.10	0.18	0.26
Below Normal (13%)		0.24	0.22	0.28	0.37	0.23	0.18	0.13	0.14	0.13	0.14	0.23	0.38
Dry (24%)		0.30	0.31	0.38	0.45	0.29	0.21	0.16	0.16	0.14	0.20	0.33	0.38
Critical (15%)		0.41	0.44	0.49	0.50	0.43	0.28	0.21	0.18	0.17	0.24	0.36	0.43

Alternative 5 minus Second Basis of Comparison

Alternative 5 minus Second Basis of Comparison		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		0.01	-0.01	0.00	-0.02	-0.05	-0.03	0.04	0.04	0.02	0.02	0.04	-0.01
20%		-0.01	-0.01	-0.02	0.00	-0.14	0.02	0.03	0.04	0.01	0.04	0.04	0.00
30%		-0.03	-0.03	-0.02	-0.04	-0.05	0.03	0.02	0.03	0.02	0.03	0.03	0.00
40%		-0.03	-0.03	-0.05	-0.05	0.03	0.03	0.02	0.03	0.02	0.01	0.00	0.00
50%		-0.06	-0.07	-0.15	-0.06	0.02	0.02	0.01	0.02	0.01	0.01	0.01	-0.03
60%		-0.22	-0.26	-0.28	-0.01	0.02	0.00	0.00	0.02	0.02	0.01	0.01	-0.03
70%		-0.30	-0.26	-0.26	0.03	0.02	0.00	0.00	0.02	0.01	0.01	0.00	-0.05
80%		-0.29	-0.25	-0.20	0.02	0.01	0.00	0.00	0.01	0.01	0.00	0.01	-0.05
90%		-0.23	-0.18	0.00	0.01	0.00	0.00	0.00	0.00	0.02	0.00	0.00	-0.03
Long Term													
Full Simulation Period ^b		-0.12	-0.11	-0.10	-0.01	-0.01	0.00	0.01	0.02	0.01	0.01	0.02	-0.02
Water Year Types ^c													
Wet (32%)		-0.14	-0.14	-0.11	0.00	0.01	0.00	0.00	0.01	0.01	0.00	0.02	-0.02
Above Normal (16%)		-0.08	-0.07	-0.09	-0.01	0.01	0.01	0.01	0.02	0.01	0.01	0.01	-0.10
Below Normal (13%)		-0.16	-0.14	-0.14	-0.04	-0.05	-0.04	0.01	0.03	0.03	0.00	0.00	0.02
Dry (24%)		-0.15	-0.11	-0.11	-0.01	-0.03	0.01	0.02	0.04	0.02	0.05	0.05	0.00
Critical (15%)		-0.07	-0.06	-0.05	-0.01	0.00	0.00	0.00	0.03	-0.05	0.00	0.01	-0.01

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1
2

B.24. Banks Pumping Plant Bromide Concentration

Table 6E.B.24.1. Banks Pumping Plant, Monthly Bromide Concentration

No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.53	0.58	0.62	0.58	0.43	0.38	0.19	0.17	0.16	0.22	0.36	0.43
20%	0.49	0.46	0.52	0.52	0.37	0.19	0.16	0.16	0.13	0.16	0.29	0.39
30%	0.45	0.43	0.45	0.43	0.32	0.16	0.14	0.15	0.12	0.15	0.24	0.37
40%	0.44	0.41	0.39	0.36	0.27	0.15	0.13	0.14	0.11	0.10	0.21	0.33
50%	0.39	0.35	0.25	0.33	0.18	0.13	0.12	0.11	0.11	0.09	0.19	0.32
60%	0.20	0.13	0.19	0.26	0.16	0.12	0.10	0.10	0.10	0.09	0.16	0.31
70%	0.19	0.09	0.10	0.17	0.14	0.11	0.09	0.10	0.10	0.08	0.15	0.28
80%	0.17	0.09	0.09	0.14	0.11	0.10	0.08	0.09	0.09	0.08	0.14	0.26
90%	0.10	0.08	0.08	0.13	0.10	0.08	0.06	0.04	0.08	0.07	0.12	0.24
Long Term												
Full Simulation Period ^b	0.32	0.30	0.31	0.33	0.24	0.17	0.13	0.12	0.12	0.13	0.21	0.32
Water Year Types ^c												
Wet (32%)	0.27	0.21	0.20	0.18	0.13	0.10	0.07	0.07	0.09	0.08	0.13	0.27
Above Normal (16%)	0.39	0.37	0.33	0.30	0.20	0.13	0.11	0.11	0.10	0.08	0.14	0.25
Below Normal (13%)	0.28	0.21	0.26	0.35	0.27	0.18	0.13	0.13	0.12	0.12	0.20	0.37
Dry (24%)	0.32	0.31	0.35	0.42	0.32	0.20	0.15	0.14	0.12	0.16	0.29	0.36
Critical (15%)	0.42	0.45	0.50	0.51	0.40	0.32	0.24	0.20	0.18	0.23	0.32	0.40

Alternative 1												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.52	0.57	0.59	0.60	0.45	0.29	0.15	0.13	0.14	0.20	0.32	0.41
20%	0.50	0.50	0.55	0.55	0.39	0.21	0.13	0.12	0.12	0.14	0.25	0.40
30%	0.49	0.47	0.52	0.49	0.30	0.15	0.11	0.12	0.10	0.12	0.22	0.37
40%	0.47	0.44	0.49	0.46	0.22	0.13	0.11	0.10	0.09	0.10	0.21	0.35
50%	0.46	0.43	0.46	0.44	0.15	0.12	0.10	0.09	0.09	0.09	0.18	0.34
60%	0.45	0.41	0.44	0.28	0.14	0.11	0.09	0.09	0.09	0.08	0.15	0.33
70%	0.43	0.39	0.40	0.15	0.11	0.10	0.09	0.08	0.08	0.08	0.14	0.33
80%	0.41	0.36	0.30	0.12	0.10	0.09	0.08	0.08	0.08	0.07	0.13	0.29
90%	0.36	0.28	0.10	0.11	0.09	0.08	0.06	0.05	0.07	0.07	0.08	0.27
Long Term												
Full Simulation Period ^b	0.44	0.42	0.43	0.36	0.23	0.15	0.12	0.10	0.10	0.12	0.19	0.34
Water Year Types ^c												
Wet (32%)	0.40	0.38	0.33	0.18	0.10	0.09	0.07	0.07	0.08	0.08	0.12	0.28
Above Normal (16%)	0.47	0.44	0.42	0.34	0.17	0.12	0.09	0.09	0.08	0.07	0.14	0.35
Below Normal (13%)	0.41	0.38	0.41	0.41	0.32	0.20	0.12	0.10	0.09	0.11	0.20	0.35
Dry (24%)	0.45	0.44	0.49	0.46	0.29	0.16	0.12	0.11	0.11	0.13	0.25	0.37
Critical (15%)	0.49	0.51	0.56	0.55	0.39	0.28	0.23	0.18	0.19	0.23	0.31	0.41

Alternative 1 minus No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.01	0.00	-0.03	0.02	0.01	-0.09	-0.04	-0.04	-0.02	-0.02	-0.04	-0.01
20%	0.01	0.03	0.03	0.03	0.02	0.02	-0.03	-0.03	-0.01	-0.02	-0.04	0.00
30%	0.04	0.04	0.06	0.07	-0.01	-0.02	-0.03	-0.03	-0.02	-0.03	-0.01	0.01
40%	0.03	0.03	0.09	0.10	-0.05	-0.02	-0.03	-0.04	-0.02	-0.01	0.00	0.02
50%	0.07	0.08	0.21	0.12	-0.03	-0.01	-0.02	-0.02	-0.02	0.00	-0.01	0.02
60%	0.25	0.28	0.25	0.01	-0.02	-0.02	-0.01	-0.02	-0.02	0.00	-0.01	0.03
70%	0.24	0.30	0.30	-0.02	-0.03	-0.01	0.00	-0.01	-0.02	0.00	0.00	0.04
80%	0.24	0.28	0.21	-0.01	-0.01	-0.01	0.00	-0.01	-0.01	0.00	-0.01	0.04
90%	0.26	0.20	0.02	-0.02	-0.01	0.00	-0.01	0.01	0.00	0.00	-0.04	0.03
Long Term												
Full Simulation Period ^b	0.11	0.13	0.12	0.03	-0.01	-0.02	-0.01	-0.02	-0.01	-0.01	-0.02	0.02
Water Year Types ^c												
Wet (32%)	0.13	0.17	0.13	0.00	-0.02	0.00	0.00	-0.01	-0.01	0.00	-0.01	0.01
Above Normal (16%)	0.08	0.07	0.08	0.05	-0.03	-0.01	-0.02	-0.02	-0.02	0.00	0.00	0.10
Below Normal (13%)	0.13	0.16	0.15	0.07	0.05	0.01	-0.02	-0.03	-0.04	-0.01	0.00	-0.02
Dry (24%)	0.14	0.13	0.13	0.04	-0.03	-0.04	-0.03	-0.03	-0.01	-0.03	-0.04	0.01
Critical (15%)	0.07	0.06	0.06	0.04	-0.01	-0.04	-0.01	-0.01	0.01	-0.01	-0.01	0.01

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.24.2. Banks Pumping Plant, Monthly Bromide Concentration

No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.53	0.58	0.62	0.58	0.43	0.38	0.19	0.17	0.16	0.22	0.36	0.43
20%	0.49	0.46	0.52	0.52	0.37	0.19	0.16	0.16	0.13	0.16	0.29	0.39
30%	0.45	0.43	0.45	0.43	0.32	0.16	0.14	0.15	0.12	0.15	0.24	0.37
40%	0.44	0.41	0.39	0.36	0.27	0.15	0.13	0.14	0.11	0.10	0.21	0.33
50%	0.39	0.35	0.25	0.33	0.18	0.13	0.12	0.11	0.11	0.09	0.19	0.32
60%	0.20	0.13	0.19	0.26	0.16	0.12	0.10	0.10	0.10	0.09	0.16	0.31
70%	0.19	0.09	0.10	0.17	0.14	0.11	0.09	0.10	0.10	0.08	0.15	0.28
80%	0.17	0.09	0.09	0.14	0.11	0.10	0.08	0.09	0.09	0.08	0.14	0.26
90%	0.10	0.08	0.08	0.13	0.10	0.08	0.06	0.04	0.08	0.07	0.12	0.24
Long Term												
Full Simulation Period ^b	0.32	0.30	0.31	0.33	0.24	0.17	0.13	0.12	0.12	0.13	0.21	0.32
Water Year Types ^c												
Wet (32%)	0.27	0.21	0.20	0.18	0.13	0.10	0.07	0.07	0.09	0.08	0.13	0.27
Above Normal (16%)	0.39	0.37	0.33	0.30	0.20	0.13	0.11	0.11	0.10	0.08	0.14	0.25
Below Normal (13%)	0.28	0.21	0.26	0.35	0.27	0.18	0.13	0.13	0.12	0.12	0.20	0.37
Dry (24%)	0.32	0.31	0.35	0.42	0.32	0.20	0.15	0.14	0.12	0.16	0.29	0.36
Critical (15%)	0.42	0.45	0.50	0.51	0.40	0.32	0.24	0.20	0.18	0.23	0.32	0.40

Alternative 3												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.53	0.57	0.60	0.59	0.43	0.36	0.18	0.16	0.14	0.23	0.36	0.44
20%	0.50	0.50	0.54	0.55	0.38	0.18	0.16	0.14	0.11	0.16	0.26	0.41
30%	0.47	0.46	0.51	0.51	0.34	0.16	0.14	0.12	0.10	0.15	0.23	0.38
40%	0.47	0.44	0.49	0.47	0.21	0.14	0.12	0.10	0.09	0.10	0.21	0.36
50%	0.45	0.42	0.47	0.44	0.17	0.12	0.10	0.09	0.08	0.09	0.18	0.35
60%	0.44	0.42	0.44	0.29	0.14	0.11	0.09	0.09	0.08	0.08	0.16	0.33
70%	0.42	0.40	0.40	0.16	0.13	0.10	0.09	0.08	0.08	0.08	0.14	0.32
80%	0.40	0.36	0.32	0.13	0.11	0.09	0.08	0.08	0.07	0.07	0.12	0.30
90%	0.36	0.32	0.10	0.12	0.09	0.08	0.06	0.05	0.07	0.07	0.08	0.26
Long Term												
Full Simulation Period ^b	0.44	0.43	0.43	0.36	0.23	0.16	0.12	0.11	0.10	0.12	0.20	0.34
Water Year Types ^c												
Wet (32%)	0.39	0.38	0.34	0.19	0.11	0.09	0.07	0.07	0.07	0.08	0.11	0.27
Above Normal (16%)	0.48	0.46	0.42	0.36	0.20	0.12	0.09	0.08	0.08	0.07	0.14	0.35
Below Normal (13%)	0.41	0.37	0.42	0.43	0.28	0.17	0.12	0.11	0.09	0.13	0.21	0.38
Dry (24%)	0.44	0.45	0.49	0.47	0.30	0.19	0.14	0.12	0.10	0.15	0.27	0.37
Critical (15%)	0.49	0.52	0.54	0.50	0.37	0.31	0.25	0.19	0.17	0.23	0.31	0.41

Alternative 3 minus No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.01	0.00	-0.02	0.01	-0.01	-0.02	-0.01	-0.01	-0.02	0.00	0.01	0.01
20%	0.01	0.04	0.02	0.03	0.01	0.00	0.00	-0.01	-0.03	0.00	-0.02	0.01
30%	0.02	0.04	0.05	0.09	0.03	0.00	-0.01	-0.03	-0.02	0.00	-0.01	0.01
40%	0.03	0.03	0.10	0.11	-0.06	-0.01	-0.01	-0.03	-0.02	-0.01	0.00	0.03
50%	0.07	0.07	0.21	0.11	-0.02	-0.01	-0.02	-0.02	-0.02	0.00	-0.01	0.03
60%	0.24	0.29	0.25	0.02	-0.02	-0.01	-0.01	-0.02	-0.02	0.00	0.00	0.02
70%	0.23	0.31	0.30	-0.01	-0.01	-0.01	0.00	-0.01	-0.02	0.00	-0.01	0.04
80%	0.23	0.27	0.22	0.00	-0.01	-0.01	0.00	-0.01	-0.02	0.00	-0.01	0.04
90%	0.26	0.23	0.02	-0.01	-0.01	0.00	0.00	0.01	-0.01	0.00	-0.04	0.02
Long Term												
Full Simulation Period ^b	0.11	0.13	0.12	0.04	-0.01	-0.01	-0.01	-0.01	-0.02	0.00	-0.01	0.02
Water Year Types ^c												
Wet (32%)	0.12	0.17	0.14	0.02	-0.01	0.00	0.00	-0.01	-0.01	0.00	-0.02	0.00
Above Normal (16%)	0.09	0.09	0.09	0.06	0.00	-0.01	-0.01	-0.02	-0.03	0.00	0.00	0.10
Below Normal (13%)	0.13	0.16	0.15	0.08	0.01	-0.01	-0.01	-0.02	-0.03	0.01	0.01	0.01
Dry (24%)	0.13	0.13	0.14	0.05	-0.02	-0.01	-0.01	-0.02	-0.02	-0.02	-0.02	0.00
Critical (15%)	0.07	0.06	0.04	-0.01	-0.03	-0.01	0.01	-0.01	-0.01	-0.01	-0.01	0.01

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.24.3. Banks Pumping Plant, Monthly Bromide Concentration

No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.53	0.58	0.62	0.58	0.43	0.38	0.19	0.17	0.16	0.22	0.36	0.43
20%	0.49	0.46	0.52	0.52	0.37	0.19	0.16	0.16	0.13	0.16	0.29	0.39
30%	0.45	0.43	0.45	0.43	0.32	0.16	0.14	0.15	0.12	0.15	0.24	0.37
40%	0.44	0.41	0.39	0.36	0.27	0.15	0.13	0.14	0.11	0.10	0.21	0.33
50%	0.39	0.35	0.25	0.33	0.18	0.13	0.12	0.11	0.11	0.09	0.19	0.32
60%	0.20	0.13	0.19	0.26	0.16	0.12	0.10	0.10	0.10	0.09	0.16	0.31
70%	0.19	0.09	0.10	0.17	0.14	0.11	0.09	0.10	0.10	0.08	0.15	0.28
80%	0.17	0.09	0.09	0.14	0.11	0.10	0.08	0.09	0.09	0.08	0.14	0.26
90%	0.10	0.08	0.08	0.13	0.10	0.08	0.06	0.04	0.08	0.07	0.12	0.24
Long Term												
Full Simulation Period ^b	0.32	0.30	0.31	0.33	0.24	0.17	0.13	0.12	0.12	0.13	0.21	0.32
Water Year Types ^c												
Wet (32%)	0.27	0.21	0.20	0.18	0.13	0.10	0.07	0.07	0.09	0.08	0.13	0.27
Above Normal (16%)	0.39	0.37	0.33	0.30	0.20	0.13	0.11	0.11	0.10	0.08	0.14	0.25
Below Normal (13%)	0.28	0.21	0.26	0.35	0.27	0.18	0.13	0.13	0.12	0.12	0.20	0.37
Dry (24%)	0.32	0.31	0.35	0.42	0.32	0.20	0.15	0.14	0.12	0.16	0.29	0.36
Critical (15%)	0.42	0.45	0.50	0.51	0.40	0.32	0.24	0.20	0.18	0.23	0.32	0.40

Alternative 5												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.52	0.58	0.62	0.58	0.44	0.38	0.20	0.19	0.18	0.23	0.36	0.43
20%	0.50	0.49	0.53	0.52	0.37	0.19	0.17	0.17	0.15	0.17	0.31	0.40
30%	0.46	0.43	0.46	0.42	0.32	0.16	0.15	0.15	0.14	0.15	0.26	0.38
40%	0.44	0.41	0.39	0.36	0.27	0.15	0.13	0.13	0.12	0.12	0.21	0.36
50%	0.41	0.36	0.25	0.33	0.18	0.13	0.12	0.11	0.11	0.09	0.20	0.32
60%	0.20	0.10	0.19	0.26	0.16	0.12	0.10	0.10	0.10	0.09	0.16	0.31
70%	0.19	0.09	0.11	0.17	0.14	0.11	0.09	0.09	0.10	0.08	0.15	0.29
80%	0.17	0.09	0.09	0.14	0.11	0.10	0.08	0.09	0.10	0.08	0.13	0.26
90%	0.10	0.08	0.08	0.13	0.10	0.08	0.06	0.04	0.08	0.07	0.12	0.23
Long Term												
Full Simulation Period ^b	0.33	0.30	0.31	0.33	0.24	0.17	0.14	0.13	0.12	0.13	0.22	0.33
Water Year Types ^c												
Wet (32%)	0.27	0.21	0.20	0.18	0.13	0.10	0.07	0.07	0.09	0.08	0.13	0.27
Above Normal (16%)	0.40	0.38	0.33	0.31	0.20	0.13	0.11	0.10	0.10	0.08	0.14	0.25
Below Normal (13%)	0.28	0.22	0.26	0.35	0.27	0.18	0.13	0.12	0.12	0.12	0.20	0.38
Dry (24%)	0.32	0.31	0.35	0.43	0.32	0.20	0.16	0.15	0.14	0.18	0.31	0.38
Critical (15%)	0.43	0.45	0.50	0.51	0.40	0.32	0.27	0.26	0.19	0.24	0.34	0.41

Alternative 5 minus No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.02	0.02	0.00	0.01	0.00
20%	0.01	0.03	0.01	0.00	0.00	0.00	0.01	0.01	0.02	0.01	0.02	0.00
30%	0.01	0.00	0.00	0.00	0.00	0.00	0.01	0.00	0.02	0.00	0.02	0.01
40%	0.00	0.00	0.00	0.00	0.00	0.00	0.00	-0.01	0.01	0.02	0.00	0.03
50%	0.02	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.00
60%	0.00	-0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
70%	0.00	0.00	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01
80%	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90%	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Long Term												
Full Simulation Period ^b	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.01	0.01	0.00	0.01	0.00
Water Year Types ^c												
Wet (32%)	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Above Normal (16%)	0.01	0.01	0.00	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Below Normal (13%)	0.00	0.00	0.00	0.00	0.00	0.00	0.00	-0.01	0.00	0.00	0.00	0.01
Dry (24%)	0.00	0.00	0.00	0.01	0.00	0.00	0.02	0.01	0.02	0.01	0.02	0.01
Critical (15%)	0.00	0.00	0.00	0.00	0.00	0.00	0.03	0.06	0.01	0.00	0.01	0.01

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.24.4. Banks Pumping Plant, Monthly Bromide Concentration

Second Basis of Comparison		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		0.52	0.57	0.59	0.60	0.45	0.29	0.15	0.13	0.14	0.20	0.32	0.41
20%		0.50	0.50	0.55	0.55	0.39	0.21	0.13	0.12	0.12	0.14	0.25	0.40
30%		0.49	0.47	0.52	0.49	0.30	0.15	0.11	0.12	0.10	0.12	0.22	0.37
40%		0.47	0.44	0.49	0.46	0.22	0.13	0.11	0.10	0.09	0.10	0.21	0.35
50%		0.46	0.43	0.46	0.44	0.15	0.12	0.10	0.09	0.09	0.09	0.18	0.34
60%		0.45	0.41	0.44	0.28	0.14	0.11	0.09	0.09	0.09	0.08	0.15	0.33
70%		0.43	0.39	0.40	0.15	0.11	0.10	0.09	0.08	0.08	0.08	0.14	0.33
80%		0.41	0.36	0.30	0.12	0.10	0.09	0.08	0.08	0.08	0.07	0.13	0.29
90%		0.36	0.28	0.10	0.11	0.09	0.08	0.06	0.05	0.07	0.07	0.08	0.27
Long Term													
Full Simulation Period ^b		0.44	0.42	0.43	0.36	0.23	0.15	0.12	0.10	0.10	0.12	0.19	0.34
Water Year Types ^c													
Wet (32%)		0.40	0.38	0.33	0.18	0.10	0.09	0.07	0.07	0.08	0.08	0.12	0.28
Above Normal (16%)		0.47	0.44	0.42	0.34	0.17	0.12	0.09	0.09	0.08	0.07	0.14	0.35
Below Normal (13%)		0.41	0.38	0.41	0.41	0.32	0.20	0.12	0.10	0.09	0.11	0.20	0.35
Dry (24%)		0.45	0.44	0.49	0.46	0.29	0.16	0.12	0.11	0.11	0.13	0.25	0.37
Critical (15%)		0.49	0.51	0.56	0.55	0.39	0.28	0.23	0.18	0.19	0.23	0.31	0.41

No Action Alternative

No Action Alternative		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		0.53	0.58	0.62	0.58	0.43	0.38	0.19	0.17	0.16	0.22	0.36	0.43
20%		0.49	0.46	0.52	0.52	0.37	0.19	0.16	0.16	0.13	0.16	0.29	0.39
30%		0.45	0.43	0.45	0.43	0.32	0.16	0.14	0.15	0.12	0.15	0.24	0.37
40%		0.44	0.41	0.39	0.36	0.27	0.15	0.13	0.14	0.11	0.10	0.21	0.33
50%		0.39	0.35	0.25	0.33	0.18	0.13	0.12	0.11	0.11	0.09	0.19	0.32
60%		0.20	0.13	0.19	0.26	0.16	0.12	0.10	0.10	0.10	0.09	0.16	0.31
70%		0.19	0.09	0.10	0.17	0.14	0.11	0.09	0.10	0.10	0.08	0.15	0.28
80%		0.17	0.09	0.09	0.14	0.11	0.10	0.08	0.09	0.09	0.08	0.14	0.26
90%		0.10	0.08	0.08	0.13	0.10	0.08	0.06	0.04	0.08	0.07	0.12	0.24
Long Term													
Full Simulation Period ^b		0.32	0.30	0.31	0.33	0.24	0.17	0.13	0.12	0.12	0.13	0.21	0.32
Water Year Types ^c													
Wet (32%)		0.27	0.21	0.20	0.18	0.13	0.10	0.07	0.07	0.09	0.08	0.13	0.27
Above Normal (16%)		0.39	0.37	0.33	0.30	0.20	0.13	0.11	0.11	0.10	0.08	0.14	0.25
Below Normal (13%)		0.28	0.21	0.26	0.35	0.27	0.18	0.13	0.13	0.12	0.12	0.20	0.37
Dry (24%)		0.32	0.31	0.35	0.42	0.32	0.20	0.15	0.14	0.12	0.16	0.29	0.36
Critical (15%)		0.42	0.45	0.50	0.51	0.40	0.32	0.24	0.20	0.18	0.23	0.32	0.40

No Action Alternative minus Second Basis of Comparison

No Action Alternative minus Second Basis of Comparison		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		0.01	0.00	0.03	-0.02	-0.01	0.09	0.04	0.04	0.02	0.02	0.04	0.01
20%		-0.01	-0.03	-0.03	-0.03	-0.02	-0.02	0.03	0.03	0.01	0.02	0.04	0.00
30%		-0.04	-0.04	-0.06	-0.07	0.01	0.02	0.03	0.03	0.02	0.03	0.01	-0.01
40%		-0.03	-0.03	-0.09	-0.10	0.05	0.02	0.03	0.04	0.02	0.01	0.00	-0.02
50%		-0.07	-0.08	-0.21	-0.12	0.03	0.01	0.02	0.02	0.02	0.00	0.01	-0.02
60%		-0.25	-0.28	-0.25	-0.01	0.02	0.02	0.01	0.02	0.02	0.00	0.01	-0.03
70%		-0.24	-0.30	-0.30	0.02	0.03	0.01	0.00	0.01	0.02	0.00	0.00	-0.04
80%		-0.24	-0.28	-0.21	0.01	0.01	0.01	0.00	0.01	0.01	0.00	0.01	-0.04
90%		-0.26	-0.20	-0.02	0.02	0.01	0.00	0.01	-0.01	0.00	0.00	0.04	-0.03
Long Term													
Full Simulation Period ^b		-0.11	-0.13	-0.12	-0.03	0.01	0.02	0.01	0.02	0.01	0.01	0.02	-0.02
Water Year Types ^c													
Wet (32%)		-0.13	-0.17	-0.13	0.00	0.02	0.00	0.00	0.01	0.01	0.00	0.01	-0.01
Above Normal (16%)		-0.08	-0.07	-0.08	-0.05	0.03	0.01	0.02	0.02	0.02	0.00	0.00	-0.10
Below Normal (13%)		-0.13	-0.16	-0.15	-0.07	-0.05	-0.01	0.02	0.03	0.04	0.01	0.00	0.02
Dry (24%)		-0.14	-0.13	-0.13	-0.04	0.03	0.04	0.03	0.03	0.01	0.03	0.04	-0.01
Critical (15%)		-0.07	-0.06	-0.06	-0.04	0.01	0.04	0.01	0.01	-0.01	0.01	0.01	-0.01

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.24.5. Banks Pumping Plant, Monthly Bromide Concentration

Second Basis of Comparison

Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.52	0.57	0.59	0.60	0.45	0.29	0.15	0.13	0.14	0.20	0.32	0.41
20%	0.50	0.50	0.55	0.55	0.39	0.21	0.13	0.12	0.12	0.14	0.25	0.40
30%	0.49	0.47	0.52	0.49	0.30	0.15	0.11	0.12	0.10	0.12	0.22	0.37
40%	0.47	0.44	0.49	0.46	0.22	0.13	0.11	0.10	0.09	0.10	0.21	0.35
50%	0.46	0.43	0.46	0.44	0.15	0.12	0.10	0.09	0.09	0.09	0.18	0.34
60%	0.45	0.41	0.44	0.28	0.14	0.11	0.09	0.09	0.09	0.08	0.15	0.33
70%	0.43	0.39	0.40	0.15	0.11	0.10	0.09	0.08	0.08	0.08	0.14	0.33
80%	0.41	0.36	0.30	0.12	0.10	0.09	0.08	0.08	0.08	0.07	0.13	0.29
90%	0.36	0.28	0.10	0.11	0.09	0.08	0.06	0.05	0.07	0.07	0.08	0.27
Long Term												
Full Simulation Period ^b	0.44	0.42	0.43	0.36	0.23	0.15	0.12	0.10	0.10	0.12	0.19	0.34
Water Year Types ^c												
Wet (32%)	0.40	0.38	0.33	0.18	0.10	0.09	0.07	0.07	0.08	0.08	0.12	0.28
Above Normal (16%)	0.47	0.44	0.42	0.34	0.17	0.12	0.09	0.09	0.08	0.07	0.14	0.35
Below Normal (13%)	0.41	0.38	0.41	0.41	0.32	0.20	0.12	0.10	0.09	0.11	0.20	0.35
Dry (24%)	0.45	0.44	0.49	0.46	0.29	0.16	0.12	0.11	0.11	0.13	0.25	0.37
Critical (15%)	0.49	0.51	0.56	0.55	0.39	0.28	0.23	0.18	0.19	0.23	0.31	0.41

Alternative 3

Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.53	0.57	0.60	0.59	0.43	0.36	0.18	0.16	0.14	0.23	0.36	0.44
20%	0.50	0.50	0.54	0.55	0.38	0.18	0.16	0.14	0.11	0.16	0.26	0.41
30%	0.47	0.46	0.51	0.51	0.34	0.16	0.14	0.12	0.10	0.15	0.23	0.38
40%	0.47	0.44	0.49	0.47	0.21	0.14	0.12	0.10	0.09	0.10	0.21	0.36
50%	0.45	0.42	0.47	0.44	0.17	0.12	0.10	0.09	0.08	0.09	0.18	0.35
60%	0.44	0.42	0.44	0.29	0.14	0.11	0.09	0.09	0.08	0.08	0.16	0.33
70%	0.42	0.40	0.40	0.16	0.13	0.10	0.09	0.08	0.08	0.08	0.14	0.32
80%	0.40	0.36	0.32	0.13	0.11	0.09	0.08	0.08	0.07	0.07	0.12	0.30
90%	0.36	0.32	0.10	0.12	0.09	0.08	0.06	0.05	0.07	0.07	0.08	0.26
Long Term												
Full Simulation Period ^b	0.44	0.43	0.43	0.36	0.23	0.16	0.12	0.11	0.10	0.12	0.20	0.34
Water Year Types ^c												
Wet (32%)	0.39	0.38	0.34	0.19	0.11	0.09	0.07	0.07	0.07	0.08	0.11	0.27
Above Normal (16%)	0.48	0.46	0.42	0.36	0.20	0.12	0.09	0.08	0.08	0.07	0.14	0.35
Below Normal (13%)	0.41	0.37	0.42	0.43	0.28	0.17	0.12	0.11	0.09	0.13	0.21	0.38
Dry (24%)	0.44	0.45	0.49	0.47	0.30	0.19	0.14	0.12	0.10	0.15	0.27	0.37
Critical (15%)	0.49	0.52	0.54	0.50	0.37	0.31	0.25	0.19	0.17	0.23	0.31	0.41

Alternative 3 minus Second Basis of Comparison

Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.02	0.00	0.01	-0.01	-0.02	0.07	0.03	0.03	0.00	0.02	0.04	0.03
20%	0.00	0.00	-0.01	0.00	-0.01	-0.03	0.03	0.02	-0.01	0.02	0.02	0.01
30%	-0.02	-0.01	-0.01	0.02	0.04	0.01	0.02	0.01	0.00	0.03	0.00	0.00
40%	0.00	0.00	0.01	0.00	-0.01	0.01	0.01	0.00	0.00	0.00	0.00	0.01
50%	0.00	-0.01	0.00	0.00	0.01	0.00	0.01	0.00	0.00	0.00	0.00	0.01
60%	-0.01	0.00	0.00	0.01	0.00	0.01	0.00	0.00	0.00	0.00	0.00	0.00
70%	-0.01	0.01	0.00	0.01	0.02	0.00	0.00	0.00	0.00	0.00	0.00	0.00
80%	0.00	0.00	0.01	0.01	0.00	0.00	0.00	0.00	-0.01	0.00	0.00	0.00
90%	0.00	0.04	0.00	0.01	0.00	0.00	0.01	0.00	-0.01	0.00	0.00	-0.01
Long Term												
Full Simulation Period ^b	0.00	0.01	0.00	0.01	0.00	0.01	0.01	0.00	-0.01	0.01	0.01	0.00
Water Year Types ^c												
Wet (32%)	0.00	0.00	0.01	0.02	0.01	0.00	0.00	0.00	-0.01	0.00	-0.01	-0.01
Above Normal (16%)	0.01	0.02	0.01	0.02	0.02	0.00	0.00	0.00	-0.01	0.00	0.00	0.00
Below Normal (13%)	0.00	0.00	0.00	0.01	-0.05	-0.02	0.01	0.01	0.01	0.02	0.01	0.04
Dry (24%)	-0.01	0.01	0.01	0.01	0.01	0.03	0.02	0.01	-0.01	0.02	0.02	0.00
Critical (15%)	0.00	0.00	-0.02	-0.05	-0.02	0.03	0.02	0.00	-0.02	0.00	0.00	0.00

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.24.6. Banks Pumping Plant, Monthly Bromide Concentration

Second Basis of Comparison		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		0.52	0.57	0.59	0.60	0.45	0.29	0.15	0.13	0.14	0.20	0.32	0.41
20%		0.50	0.50	0.55	0.55	0.39	0.21	0.13	0.12	0.12	0.14	0.25	0.40
30%		0.49	0.47	0.52	0.49	0.30	0.15	0.11	0.12	0.10	0.12	0.22	0.37
40%		0.47	0.44	0.49	0.46	0.22	0.13	0.11	0.10	0.09	0.10	0.21	0.35
50%		0.46	0.43	0.46	0.44	0.15	0.12	0.10	0.09	0.09	0.09	0.18	0.34
60%		0.45	0.41	0.44	0.28	0.14	0.11	0.09	0.09	0.09	0.08	0.15	0.33
70%		0.43	0.39	0.40	0.15	0.11	0.10	0.09	0.08	0.08	0.08	0.14	0.33
80%		0.41	0.36	0.30	0.12	0.10	0.09	0.08	0.08	0.08	0.07	0.13	0.29
90%		0.36	0.28	0.10	0.11	0.09	0.08	0.06	0.05	0.07	0.07	0.08	0.27
Long Term													
Full Simulation Period ^b		0.44	0.42	0.43	0.36	0.23	0.15	0.12	0.10	0.10	0.12	0.19	0.34
Water Year Types ^c													
Wet (32%)		0.40	0.38	0.33	0.18	0.10	0.09	0.07	0.07	0.08	0.08	0.12	0.28
Above Normal (16%)		0.47	0.44	0.42	0.34	0.17	0.12	0.09	0.09	0.08	0.07	0.14	0.35
Below Normal (13%)		0.41	0.38	0.41	0.41	0.32	0.20	0.12	0.10	0.09	0.11	0.20	0.35
Dry (24%)		0.45	0.44	0.49	0.46	0.29	0.16	0.12	0.11	0.11	0.13	0.25	0.37
Critical (15%)		0.49	0.51	0.56	0.55	0.39	0.28	0.23	0.18	0.19	0.23	0.31	0.41

Alternative 5		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		0.52	0.58	0.62	0.58	0.44	0.38	0.20	0.19	0.18	0.23	0.36	0.43
20%		0.50	0.49	0.53	0.52	0.37	0.19	0.17	0.17	0.15	0.17	0.31	0.40
30%		0.46	0.43	0.46	0.42	0.32	0.16	0.15	0.15	0.14	0.15	0.26	0.38
40%		0.44	0.41	0.39	0.36	0.27	0.15	0.13	0.13	0.12	0.12	0.21	0.36
50%		0.41	0.36	0.25	0.33	0.18	0.13	0.12	0.11	0.11	0.09	0.20	0.32
60%		0.20	0.10	0.19	0.26	0.16	0.12	0.10	0.10	0.10	0.09	0.16	0.31
70%		0.19	0.09	0.11	0.17	0.14	0.11	0.09	0.09	0.10	0.08	0.15	0.29
80%		0.17	0.09	0.09	0.14	0.11	0.10	0.08	0.09	0.10	0.08	0.13	0.26
90%		0.10	0.08	0.08	0.13	0.10	0.08	0.06	0.04	0.08	0.07	0.12	0.23
Long Term													
Full Simulation Period ^b		0.33	0.30	0.31	0.33	0.24	0.17	0.14	0.13	0.12	0.13	0.22	0.33
Water Year Types ^c													
Wet (32%)		0.27	0.21	0.20	0.18	0.13	0.10	0.07	0.07	0.09	0.08	0.13	0.27
Above Normal (16%)		0.40	0.38	0.33	0.31	0.20	0.13	0.11	0.10	0.10	0.08	0.14	0.25
Below Normal (13%)		0.28	0.22	0.26	0.35	0.27	0.18	0.13	0.12	0.12	0.12	0.20	0.38
Dry (24%)		0.32	0.31	0.35	0.43	0.32	0.20	0.16	0.15	0.14	0.18	0.31	0.38
Critical (15%)		0.43	0.45	0.50	0.51	0.40	0.32	0.27	0.26	0.19	0.24	0.34	0.41

Alternative 5 minus Second Basis of Comparison		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		0.01	0.01	0.03	-0.02	-0.01	0.09	0.05	0.06	0.04	0.02	0.04	0.01
20%		0.00	0.00	-0.02	-0.03	-0.02	-0.02	0.04	0.04	0.03	0.03	0.06	0.00
30%		-0.03	-0.04	-0.06	-0.07	0.01	0.02	0.04	0.04	0.04	0.04	0.03	0.01
40%		-0.02	-0.03	-0.09	-0.10	0.05	0.02	0.03	0.03	0.03	0.02	0.00	0.01
50%		-0.05	-0.07	-0.21	-0.12	0.03	0.01	0.02	0.02	0.02	0.00	0.01	-0.02
60%		-0.24	-0.31	-0.25	-0.01	0.02	0.02	0.01	0.02	0.02	0.00	0.01	-0.02
70%		-0.24	-0.30	-0.29	0.03	0.03	0.01	0.00	0.01	0.02	0.00	0.01	-0.03
80%		-0.23	-0.28	-0.21	0.02	0.01	0.01	0.00	0.01	0.02	0.00	0.00	-0.03
90%		-0.26	-0.20	-0.01	0.02	0.01	0.00	0.01	-0.01	0.00	0.00	0.04	-0.04
Long Term													
Full Simulation Period ^b		-0.11	-0.12	-0.12	-0.03	0.01	0.02	0.02	0.03	0.02	0.02	0.02	-0.01
Water Year Types ^c													
Wet (32%)		-0.13	-0.16	-0.13	0.00	0.02	0.00	0.00	0.00	0.01	0.00	0.01	-0.01
Above Normal (16%)		-0.07	-0.06	-0.09	-0.04	0.03	0.01	0.01	0.02	0.02	0.00	0.00	-0.10
Below Normal (13%)		-0.13	-0.16	-0.15	-0.07	-0.05	-0.01	0.01	0.02	0.04	0.01	0.00	0.03
Dry (24%)		-0.13	-0.13	-0.14	-0.03	0.03	0.04	0.04	0.04	0.03	0.05	0.06	0.01
Critical (15%)		-0.06	-0.06	-0.06	-0.04	0.01	0.04	0.04	0.07	0.00	0.01	0.03	0.00

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1
2

B.25. Old River at Rock Slough Bromide Concentration

Table 6E.B.25.1. Old River at Rock Slough, Monthly Bromide Concentration

No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.77	0.83	0.78	0.62	0.31	0.13	0.12	0.12	0.09	0.29	0.49	0.64
20%	0.71	0.65	0.69	0.51	0.27	0.10	0.11	0.11	0.08	0.20	0.43	0.59
30%	0.65	0.57	0.58	0.40	0.17	0.09	0.10	0.10	0.07	0.18	0.36	0.55
40%	0.60	0.52	0.38	0.33	0.14	0.08	0.10	0.10	0.07	0.16	0.30	0.51
50%	0.56	0.39	0.24	0.28	0.12	0.08	0.09	0.10	0.07	0.12	0.26	0.44
60%	0.13	0.14	0.18	0.23	0.10	0.07	0.09	0.09	0.07	0.08	0.23	0.39
70%	0.12	0.06	0.14	0.11	0.08	0.07	0.08	0.09	0.06	0.06	0.19	0.37
80%	0.11	0.06	0.11	0.09	0.08	0.06	0.08	0.07	0.06	0.06	0.18	0.31
90%	0.11	0.05	0.06	0.08	0.07	0.06	0.07	0.05	0.06	0.05	0.16	0.28
Long Term												
Full Simulation Period ^b	0.42	0.38	0.37	0.31	0.16	0.10	0.09	0.09	0.08	0.15	0.29	0.45
Water Year Types ^c												
Wet (32%)	0.30	0.24	0.19	0.13	0.10	0.07	0.08	0.08	0.06	0.06	0.17	0.33
Above Normal (16%)	0.55	0.49	0.38	0.26	0.12	0.07	0.10	0.10	0.07	0.08	0.20	0.29
Below Normal (13%)	0.30	0.26	0.33	0.33	0.16	0.09	0.10	0.11	0.07	0.15	0.28	0.56
Dry (24%)	0.42	0.41	0.45	0.43	0.20	0.10	0.10	0.09	0.07	0.22	0.40	0.53
Critical (15%)	0.62	0.63	0.66	0.53	0.29	0.16	0.12	0.13	0.17	0.32	0.49	0.63

Alternative 1												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.78	0.83	0.85	0.70	0.46	0.19	0.10	0.09	0.12	0.28	0.47	0.64
20%	0.72	0.72	0.75	0.62	0.32	0.13	0.08	0.08	0.08	0.18	0.36	0.60
30%	0.69	0.66	0.73	0.56	0.22	0.10	0.08	0.07	0.07	0.17	0.33	0.57
40%	0.67	0.61	0.70	0.51	0.15	0.08	0.07	0.07	0.07	0.14	0.30	0.54
50%	0.64	0.59	0.61	0.38	0.12	0.07	0.06	0.06	0.06	0.11	0.25	0.53
60%	0.63	0.57	0.55	0.27	0.09	0.07	0.06	0.06	0.06	0.07	0.22	0.51
70%	0.60	0.54	0.46	0.13	0.08	0.06	0.06	0.06	0.05	0.06	0.18	0.50
80%	0.58	0.44	0.32	0.09	0.07	0.06	0.06	0.06	0.05	0.06	0.16	0.45
90%	0.51	0.30	0.12	0.07	0.06	0.05	0.05	0.05	0.05	0.05	0.15	0.39
Long Term												
Full Simulation Period ^b	0.63	0.58	0.56	0.38	0.19	0.10	0.07	0.07	0.08	0.14	0.28	0.52
Water Year Types ^c												
Wet (32%)	0.56	0.52	0.39	0.14	0.09	0.07	0.07	0.06	0.06	0.06	0.16	0.42
Above Normal (16%)	0.70	0.60	0.54	0.35	0.12	0.07	0.06	0.06	0.05	0.07	0.20	0.53
Below Normal (13%)	0.57	0.51	0.57	0.48	0.28	0.12	0.07	0.07	0.06	0.15	0.28	0.53
Dry (24%)	0.65	0.60	0.67	0.51	0.25	0.10	0.07	0.07	0.08	0.19	0.35	0.56
Critical (15%)	0.73	0.71	0.77	0.60	0.31	0.18	0.11	0.12	0.19	0.32	0.48	0.65

Alternative 1 minus No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.01	0.00	0.06	0.09	0.15	0.06	-0.02	-0.03	0.03	-0.01	-0.02	0.00
20%	0.01	0.07	0.05	0.10	0.05	0.03	-0.03	-0.03	0.00	-0.02	-0.06	0.01
30%	0.03	0.09	0.14	0.16	0.05	0.01	-0.02	-0.03	0.00	-0.01	-0.03	0.02
40%	0.06	0.09	0.32	0.18	0.02	0.00	-0.03	-0.03	0.00	-0.02	0.00	0.03
50%	0.08	0.20	0.36	0.10	0.00	-0.01	-0.03	-0.03	-0.01	-0.01	-0.01	0.08
60%	0.50	0.43	0.37	0.04	-0.01	-0.01	-0.03	-0.03	-0.01	-0.01	0.00	0.12
70%	0.48	0.48	0.33	0.02	0.00	-0.01	-0.02	-0.03	-0.01	0.00	-0.01	0.14
80%	0.46	0.38	0.21	0.00	0.00	0.00	-0.02	-0.02	-0.01	0.00	-0.01	0.14
90%	0.40	0.24	0.06	-0.01	-0.01	-0.01	-0.01	0.00	-0.01	0.00	-0.01	0.11
Long Term												
Full Simulation Period ^b	0.21	0.20	0.19	0.07	0.03	0.00	-0.02	-0.02	0.00	-0.01	-0.02	0.07
Water Year Types ^c												
Wet (32%)	0.26	0.28	0.20	0.01	-0.01	0.00	-0.01	-0.02	0.00	0.00	-0.01	0.09
Above Normal (16%)	0.15	0.11	0.17	0.09	0.01	-0.01	-0.04	-0.04	-0.01	0.00	0.00	0.23
Below Normal (13%)	0.27	0.25	0.25	0.15	0.12	0.03	-0.03	-0.04	-0.01	0.00	0.00	-0.03
Dry (24%)	0.23	0.19	0.22	0.08	0.04	-0.01	-0.02	-0.02	0.01	-0.04	-0.05	0.03
Critical (15%)	0.11	0.08	0.11	0.07	0.02	0.02	-0.01	-0.01	0.02	0.00	-0.01	0.02

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.25.2. Old River at Rock Slough, Monthly Bromide Concentration

No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.77	0.83	0.78	0.62	0.31	0.13	0.12	0.12	0.09	0.29	0.49	0.64
20%	0.71	0.65	0.69	0.51	0.27	0.10	0.11	0.11	0.08	0.20	0.43	0.59
30%	0.65	0.57	0.58	0.40	0.17	0.09	0.10	0.10	0.07	0.18	0.36	0.55
40%	0.60	0.52	0.38	0.33	0.14	0.08	0.10	0.10	0.07	0.16	0.30	0.51
50%	0.56	0.39	0.24	0.28	0.12	0.08	0.09	0.10	0.07	0.12	0.26	0.44
60%	0.13	0.14	0.18	0.23	0.10	0.07	0.09	0.09	0.07	0.08	0.23	0.39
70%	0.12	0.06	0.14	0.11	0.08	0.07	0.08	0.09	0.06	0.06	0.19	0.37
80%	0.11	0.06	0.11	0.09	0.08	0.06	0.08	0.07	0.06	0.06	0.18	0.31
90%	0.11	0.05	0.06	0.08	0.07	0.06	0.07	0.05	0.06	0.05	0.16	0.28
Long Term												
Full Simulation Period ^b	0.42	0.38	0.37	0.31	0.16	0.10	0.09	0.09	0.08	0.15	0.29	0.45
Water Year Types ^c												
Wet (32%)	0.30	0.24	0.19	0.13	0.10	0.07	0.08	0.08	0.06	0.06	0.17	0.33
Above Normal (16%)	0.55	0.49	0.38	0.26	0.12	0.07	0.10	0.10	0.07	0.08	0.20	0.29
Below Normal (13%)	0.30	0.26	0.33	0.33	0.16	0.09	0.10	0.11	0.07	0.15	0.28	0.56
Dry (24%)	0.42	0.41	0.45	0.43	0.20	0.10	0.10	0.09	0.07	0.22	0.40	0.53
Critical (15%)	0.62	0.63	0.66	0.53	0.29	0.16	0.12	0.13	0.17	0.32	0.49	0.63

Alternative 3												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.78	0.82	0.85	0.63	0.31	0.12	0.10	0.09	0.13	0.34	0.49	0.66
20%	0.72	0.72	0.76	0.57	0.25	0.10	0.09	0.08	0.08	0.21	0.41	0.60
30%	0.69	0.66	0.72	0.52	0.20	0.09	0.08	0.07	0.07	0.19	0.33	0.57
40%	0.67	0.61	0.69	0.45	0.13	0.08	0.08	0.06	0.06	0.16	0.31	0.55
50%	0.64	0.59	0.60	0.39	0.10	0.08	0.07	0.06	0.06	0.11	0.27	0.53
60%	0.62	0.56	0.54	0.20	0.09	0.07	0.06	0.06	0.05	0.10	0.22	0.51
70%	0.59	0.54	0.45	0.11	0.08	0.06	0.06	0.05	0.05	0.06	0.18	0.50
80%	0.57	0.49	0.31	0.09	0.07	0.06	0.06	0.05	0.05	0.06	0.16	0.45
90%	0.52	0.34	0.12	0.07	0.06	0.05	0.05	0.05	0.05	0.06	0.14	0.40
Long Term												
Full Simulation Period ^b	0.63	0.59	0.55	0.34	0.16	0.09	0.08	0.07	0.08	0.16	0.28	0.52
Water Year Types ^c												
Wet (32%)	0.55	0.53	0.39	0.15	0.09	0.07	0.06	0.05	0.05	0.06	0.15	0.41
Above Normal (16%)	0.71	0.63	0.54	0.33	0.11	0.07	0.06	0.06	0.05	0.09	0.20	0.53
Below Normal (13%)	0.58	0.50	0.58	0.42	0.18	0.09	0.07	0.07	0.07	0.17	0.30	0.57
Dry (24%)	0.64	0.62	0.67	0.47	0.19	0.10	0.08	0.07	0.07	0.22	0.38	0.55
Critical (15%)	0.73	0.71	0.71	0.51	0.28	0.16	0.11	0.12	0.19	0.32	0.48	0.65

Alternative 3 minus No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.00	-0.02	0.06	0.01	0.00	-0.01	-0.02	-0.03	0.04	0.05	0.01	0.03
20%	0.01	0.07	0.07	0.05	-0.02	0.00	-0.02	-0.03	0.01	0.00	-0.01	0.01
30%	0.04	0.09	0.13	0.12	0.02	0.00	-0.02	-0.04	-0.01	0.01	-0.03	0.02
40%	0.07	0.09	0.30	0.11	-0.01	0.00	-0.02	-0.04	-0.01	0.00	0.01	0.04
50%	0.08	0.19	0.36	0.10	-0.02	0.00	-0.02	-0.04	-0.01	-0.01	0.01	0.09
60%	0.49	0.42	0.37	-0.03	-0.01	0.00	-0.03	-0.03	-0.01	0.02	-0.01	0.12
70%	0.47	0.48	0.31	0.00	0.00	0.00	-0.02	-0.03	-0.01	0.00	-0.01	0.13
80%	0.46	0.44	0.20	0.00	0.00	0.00	-0.02	-0.02	-0.01	0.00	-0.02	0.14
90%	0.42	0.29	0.06	-0.01	-0.01	0.00	-0.01	0.00	-0.01	0.00	-0.02	0.12
Long Term												
Full Simulation Period ^b	0.21	0.21	0.19	0.03	-0.01	0.00	-0.02	-0.03	0.00	0.00	-0.01	0.07
Water Year Types ^c												
Wet (32%)	0.25	0.29	0.20	0.02	-0.01	0.00	-0.01	-0.02	-0.01	0.00	-0.02	0.08
Above Normal (16%)	0.17	0.14	0.16	0.07	-0.01	-0.01	-0.04	-0.05	-0.01	0.01	0.00	0.24
Below Normal (13%)	0.27	0.24	0.25	0.09	0.01	0.00	-0.03	-0.04	0.00	0.02	0.02	0.01
Dry (24%)	0.22	0.21	0.22	0.04	-0.01	-0.01	-0.02	-0.02	0.00	0.00	-0.02	0.02
Critical (15%)	0.11	0.08	0.05	-0.02	-0.01	-0.01	-0.01	-0.01	0.02	0.00	0.00	0.02

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.25.3. Old River at Rock Slough, Monthly Bromide Concentration

No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.77	0.83	0.78	0.62	0.31	0.13	0.12	0.12	0.09	0.29	0.49	0.64
20%	0.71	0.65	0.69	0.51	0.27	0.10	0.11	0.11	0.08	0.20	0.43	0.59
30%	0.65	0.57	0.58	0.40	0.17	0.09	0.10	0.10	0.07	0.18	0.36	0.55
40%	0.60	0.52	0.38	0.33	0.14	0.08	0.10	0.10	0.07	0.16	0.30	0.51
50%	0.56	0.39	0.24	0.28	0.12	0.08	0.09	0.10	0.07	0.12	0.26	0.44
60%	0.13	0.14	0.18	0.23	0.10	0.07	0.09	0.09	0.07	0.08	0.23	0.39
70%	0.12	0.06	0.14	0.11	0.08	0.07	0.08	0.09	0.06	0.06	0.19	0.37
80%	0.11	0.06	0.11	0.09	0.08	0.06	0.08	0.07	0.06	0.06	0.18	0.31
90%	0.11	0.05	0.06	0.08	0.07	0.06	0.07	0.05	0.06	0.05	0.16	0.28
Long Term												
Full Simulation Period ^b	0.42	0.38	0.37	0.31	0.16	0.10	0.09	0.09	0.08	0.15	0.29	0.45
Water Year Types ^c												
Wet (32%)	0.30	0.24	0.19	0.13	0.10	0.07	0.08	0.08	0.06	0.06	0.17	0.33
Above Normal (16%)	0.55	0.49	0.38	0.26	0.12	0.07	0.10	0.10	0.07	0.08	0.20	0.29
Below Normal (13%)	0.30	0.26	0.33	0.33	0.16	0.09	0.10	0.11	0.07	0.15	0.28	0.56
Dry (24%)	0.42	0.41	0.45	0.43	0.20	0.10	0.10	0.09	0.07	0.22	0.40	0.53
Critical (15%)	0.62	0.63	0.66	0.53	0.29	0.16	0.12	0.13	0.17	0.32	0.49	0.63

Alternative 5												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.80	0.83	0.78	0.66	0.31	0.13	0.15	0.16	0.11	0.30	0.50	0.64
20%	0.71	0.68	0.67	0.52	0.27	0.10	0.13	0.15	0.09	0.23	0.45	0.59
30%	0.66	0.58	0.59	0.40	0.19	0.09	0.13	0.14	0.08	0.19	0.37	0.57
40%	0.62	0.52	0.43	0.33	0.14	0.08	0.12	0.13	0.08	0.17	0.31	0.52
50%	0.55	0.40	0.23	0.28	0.12	0.08	0.11	0.12	0.07	0.11	0.26	0.45
60%	0.13	0.14	0.17	0.23	0.10	0.07	0.10	0.11	0.07	0.07	0.22	0.39
70%	0.12	0.06	0.14	0.11	0.08	0.07	0.09	0.10	0.06	0.06	0.20	0.37
80%	0.12	0.06	0.11	0.09	0.08	0.06	0.08	0.09	0.06	0.06	0.18	0.32
90%	0.11	0.05	0.06	0.08	0.07	0.06	0.07	0.05	0.06	0.05	0.16	0.28
Long Term												
Full Simulation Period ^b	0.42	0.38	0.37	0.31	0.17	0.10	0.11	0.12	0.08	0.16	0.30	0.46
Water Year Types ^c												
Wet (32%)	0.30	0.25	0.19	0.13	0.10	0.07	0.08	0.08	0.06	0.06	0.17	0.33
Above Normal (16%)	0.56	0.48	0.37	0.26	0.12	0.07	0.10	0.11	0.07	0.08	0.20	0.29
Below Normal (13%)	0.30	0.26	0.33	0.33	0.16	0.09	0.12	0.13	0.08	0.16	0.28	0.57
Dry (24%)	0.42	0.41	0.44	0.44	0.21	0.10	0.13	0.14	0.08	0.24	0.43	0.55
Critical (15%)	0.62	0.63	0.66	0.54	0.30	0.17	0.16	0.16	0.16	0.30	0.50	0.64

Alternative 5 minus No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.03	0.00	0.00	0.04	0.00	0.00	0.03	0.04	0.02	0.01	0.01	0.00
20%	0.00	0.04	-0.02	0.01	0.00	0.00	0.02	0.04	0.02	0.03	0.02	0.00
30%	0.01	0.01	0.00	0.00	0.01	0.00	0.02	0.04	0.01	0.01	0.01	0.02
40%	0.02	-0.01	0.04	0.00	0.01	0.00	0.02	0.03	0.01	0.00	0.01	0.01
50%	-0.01	0.01	-0.02	0.00	0.00	0.00	0.02	0.02	0.00	-0.01	0.00	0.01
60%	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.02	0.00	-0.01	0.00	0.00
70%	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.02	0.00	0.00	0.00	0.00
80%	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.02	0.00	0.00	0.00	0.00
90%	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Long Term												
Full Simulation Period ^b	0.00	0.00	0.00	0.00	0.00	0.00	0.02	0.02	0.00	0.00	0.01	0.01
Water Year Types ^c												
Wet (32%)	0.00	0.01	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Above Normal (16%)	0.01	-0.01	-0.01	0.00	0.00	0.00	0.00	0.01	0.00	0.00	0.00	0.00
Below Normal (13%)	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.02	0.01	0.00	0.00	0.01
Dry (24%)	0.00	0.00	0.00	0.01	0.01	0.00	0.03	0.05	0.01	0.02	0.03	0.02
Critical (15%)	0.00	0.00	0.00	0.00	0.01	0.01	0.05	0.03	-0.01	-0.02	0.01	0.01

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.25.4. Old River at Rock Slough, Monthly Bromide Concentration

Second Basis of Comparison		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		0.78	0.83	0.85	0.70	0.46	0.19	0.10	0.09	0.12	0.28	0.47	0.64
20%		0.72	0.72	0.75	0.62	0.32	0.13	0.08	0.08	0.08	0.18	0.36	0.60
30%		0.69	0.66	0.73	0.56	0.22	0.10	0.08	0.07	0.07	0.17	0.33	0.57
40%		0.67	0.61	0.70	0.51	0.15	0.08	0.07	0.07	0.07	0.14	0.30	0.54
50%		0.64	0.59	0.61	0.38	0.12	0.07	0.06	0.06	0.06	0.11	0.25	0.53
60%		0.63	0.57	0.55	0.27	0.09	0.07	0.06	0.06	0.06	0.07	0.22	0.51
70%		0.60	0.54	0.46	0.13	0.08	0.06	0.06	0.06	0.05	0.06	0.18	0.50
80%		0.58	0.44	0.32	0.09	0.07	0.06	0.06	0.06	0.05	0.06	0.16	0.45
90%		0.51	0.30	0.12	0.07	0.06	0.05	0.05	0.05	0.05	0.05	0.15	0.39
Long Term													
Full Simulation Period ^b		0.63	0.58	0.56	0.38	0.19	0.10	0.07	0.07	0.08	0.14	0.28	0.52
Water Year Types ^c													
Wet (32%)		0.56	0.52	0.39	0.14	0.09	0.07	0.07	0.06	0.06	0.06	0.16	0.42
Above Normal (16%)		0.70	0.60	0.54	0.35	0.12	0.07	0.06	0.06	0.05	0.07	0.20	0.53
Below Normal (13%)		0.57	0.51	0.57	0.48	0.28	0.12	0.07	0.07	0.06	0.15	0.28	0.53
Dry (24%)		0.65	0.60	0.67	0.51	0.25	0.10	0.07	0.07	0.08	0.19	0.35	0.56
Critical (15%)		0.73	0.71	0.77	0.60	0.31	0.18	0.11	0.12	0.19	0.32	0.48	0.65

No Action Alternative		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		0.77	0.83	0.78	0.62	0.31	0.13	0.12	0.12	0.09	0.29	0.49	0.64
20%		0.71	0.65	0.69	0.51	0.27	0.10	0.11	0.11	0.08	0.20	0.43	0.59
30%		0.65	0.57	0.58	0.40	0.17	0.09	0.10	0.10	0.07	0.18	0.36	0.55
40%		0.60	0.52	0.38	0.33	0.14	0.08	0.10	0.10	0.07	0.16	0.30	0.51
50%		0.56	0.39	0.24	0.28	0.12	0.08	0.09	0.10	0.07	0.12	0.26	0.44
60%		0.13	0.14	0.18	0.23	0.10	0.07	0.09	0.09	0.07	0.08	0.23	0.39
70%		0.12	0.06	0.14	0.11	0.08	0.07	0.08	0.09	0.06	0.06	0.19	0.37
80%		0.11	0.06	0.11	0.09	0.08	0.06	0.08	0.07	0.06	0.06	0.18	0.31
90%		0.11	0.05	0.06	0.08	0.07	0.06	0.07	0.05	0.06	0.05	0.16	0.28
Long Term													
Full Simulation Period ^b		0.42	0.38	0.37	0.31	0.16	0.10	0.09	0.09	0.08	0.15	0.29	0.45
Water Year Types ^c													
Wet (32%)		0.30	0.24	0.19	0.13	0.10	0.07	0.08	0.08	0.06	0.06	0.17	0.33
Above Normal (16%)		0.55	0.49	0.38	0.26	0.12	0.07	0.10	0.10	0.07	0.08	0.20	0.29
Below Normal (13%)		0.30	0.26	0.33	0.33	0.16	0.09	0.10	0.11	0.07	0.15	0.28	0.56
Dry (24%)		0.42	0.41	0.45	0.43	0.20	0.10	0.10	0.09	0.07	0.22	0.40	0.53
Critical (15%)		0.62	0.63	0.66	0.53	0.29	0.16	0.12	0.13	0.17	0.32	0.49	0.63

No Action Alternative minus Second Basis of Comparison		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		-0.01	0.00	-0.06	-0.09	-0.15	-0.06	0.02	0.03	-0.03	0.01	0.02	0.00
20%		-0.01	-0.07	-0.05	-0.10	-0.05	-0.03	0.03	0.03	0.00	0.02	0.06	-0.01
30%		-0.03	-0.09	-0.14	-0.16	-0.05	-0.01	0.02	0.03	0.00	0.01	0.03	-0.02
40%		-0.06	-0.09	-0.32	-0.18	-0.02	0.00	0.03	0.03	0.00	0.02	0.00	-0.03
50%		-0.08	-0.20	-0.36	-0.10	0.00	0.01	0.03	0.03	0.01	0.01	0.01	-0.08
60%		-0.50	-0.43	-0.37	-0.04	0.01	0.01	0.03	0.03	0.01	0.01	0.00	-0.12
70%		-0.48	-0.48	-0.33	-0.02	0.00	0.01	0.02	0.03	0.01	0.00	0.01	-0.14
80%		-0.46	-0.38	-0.21	0.00	0.00	0.00	0.02	0.02	0.01	0.00	0.01	-0.14
90%		-0.40	-0.24	-0.06	0.01	0.01	0.01	0.01	0.00	0.01	0.00	0.01	-0.11
Long Term													
Full Simulation Period ^b		-0.21	-0.20	-0.19	-0.07	-0.03	0.00	0.02	0.02	0.00	0.01	0.02	-0.07
Water Year Types ^c													
Wet (32%)		-0.26	-0.28	-0.20	-0.01	0.01	0.00	0.01	0.02	0.00	0.00	0.01	-0.09
Above Normal (16%)		-0.15	-0.11	-0.17	-0.09	-0.01	0.01	0.04	0.04	0.01	0.00	0.00	-0.23
Below Normal (13%)		-0.27	-0.25	-0.25	-0.15	-0.12	-0.03	0.03	0.04	0.01	0.00	0.00	0.03
Dry (24%)		-0.23	-0.19	-0.22	-0.08	-0.04	0.01	0.02	0.02	0.01	0.04	0.05	-0.03
Critical (15%)		-0.11	-0.08	-0.11	-0.07	-0.02	-0.02	0.01	0.01	-0.02	0.00	0.01	-0.02

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.25.5. Old River at Rock Slough, Monthly Bromide Concentration

Second Basis of Comparison		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		0.78	0.83	0.85	0.70	0.46	0.19	0.10	0.09	0.12	0.28	0.47	0.64
20%		0.72	0.72	0.75	0.62	0.32	0.13	0.08	0.08	0.08	0.18	0.36	0.60
30%		0.69	0.66	0.73	0.56	0.22	0.10	0.08	0.07	0.07	0.17	0.33	0.57
40%		0.67	0.61	0.70	0.51	0.15	0.08	0.07	0.07	0.07	0.14	0.30	0.54
50%		0.64	0.59	0.61	0.38	0.12	0.07	0.06	0.06	0.06	0.11	0.25	0.53
60%		0.63	0.57	0.55	0.27	0.09	0.07	0.06	0.06	0.06	0.07	0.22	0.51
70%		0.60	0.54	0.46	0.13	0.08	0.06	0.06	0.06	0.05	0.06	0.18	0.50
80%		0.58	0.44	0.32	0.09	0.07	0.06	0.06	0.06	0.05	0.06	0.16	0.45
90%		0.51	0.30	0.12	0.07	0.06	0.05	0.05	0.05	0.05	0.15	0.39	
Long Term													
Full Simulation Period ^b		0.63	0.58	0.56	0.38	0.19	0.10	0.07	0.07	0.08	0.14	0.28	0.52
Water Year Types ^c													
Wet (32%)		0.56	0.52	0.39	0.14	0.09	0.07	0.07	0.06	0.06	0.06	0.16	0.42
Above Normal (16%)		0.70	0.60	0.54	0.35	0.12	0.07	0.06	0.06	0.05	0.07	0.20	0.53
Below Normal (13%)		0.57	0.51	0.57	0.48	0.28	0.12	0.07	0.07	0.06	0.15	0.28	0.53
Dry (24%)		0.65	0.60	0.67	0.51	0.25	0.10	0.07	0.07	0.08	0.19	0.35	0.56
Critical (15%)		0.73	0.71	0.77	0.60	0.31	0.18	0.11	0.12	0.19	0.32	0.48	0.65

Alternative 3		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		0.78	0.82	0.85	0.63	0.31	0.12	0.10	0.09	0.13	0.34	0.49	0.66
20%		0.72	0.72	0.76	0.57	0.25	0.10	0.09	0.08	0.08	0.21	0.41	0.60
30%		0.69	0.66	0.72	0.52	0.20	0.09	0.08	0.07	0.07	0.19	0.33	0.57
40%		0.67	0.61	0.69	0.45	0.13	0.08	0.08	0.06	0.06	0.16	0.31	0.55
50%		0.64	0.59	0.60	0.39	0.10	0.08	0.07	0.06	0.06	0.11	0.27	0.53
60%		0.62	0.56	0.54	0.20	0.09	0.07	0.06	0.06	0.05	0.10	0.22	0.51
70%		0.59	0.54	0.45	0.11	0.08	0.06	0.06	0.05	0.05	0.06	0.18	0.50
80%		0.57	0.49	0.31	0.09	0.07	0.06	0.06	0.05	0.05	0.06	0.16	0.45
90%		0.52	0.34	0.12	0.07	0.06	0.05	0.05	0.05	0.05	0.14	0.40	
Long Term													
Full Simulation Period ^b		0.63	0.59	0.55	0.34	0.16	0.09	0.08	0.07	0.08	0.16	0.28	0.52
Water Year Types ^c													
Wet (32%)		0.55	0.53	0.39	0.15	0.09	0.07	0.06	0.05	0.05	0.06	0.15	0.41
Above Normal (16%)		0.71	0.63	0.54	0.33	0.11	0.07	0.06	0.06	0.05	0.09	0.20	0.53
Below Normal (13%)		0.58	0.50	0.58	0.42	0.18	0.09	0.07	0.07	0.07	0.17	0.30	0.57
Dry (24%)		0.64	0.62	0.67	0.47	0.19	0.10	0.08	0.07	0.07	0.22	0.38	0.55
Critical (15%)		0.73	0.71	0.71	0.51	0.28	0.16	0.11	0.12	0.19	0.32	0.48	0.65

Alternative 3 minus Second Basis of Comparison		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		0.00	-0.01	0.00	-0.08	-0.15	-0.07	0.00	0.00	0.01	0.06	0.03	0.02
20%		0.00	0.00	0.02	-0.05	-0.07	-0.03	0.01	0.00	0.00	0.02	0.05	0.00
30%		0.01	0.00	-0.01	-0.04	-0.02	-0.01	0.00	0.00	0.00	0.02	0.00	0.00
40%		0.00	0.00	-0.01	-0.07	-0.03	0.00	0.01	0.00	0.00	0.02	0.01	0.02
50%		-0.01	0.00	-0.01	0.00	-0.02	0.00	0.01	0.00	0.00	0.00	0.02	0.01
60%		-0.01	0.00	-0.01	-0.08	0.00	0.00	0.00	0.00	0.00	0.04	0.00	0.00
70%		-0.01	0.00	-0.02	-0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	-0.01
80%		-0.01	0.05	-0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90%		0.01	0.04	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	-0.01	0.01
Long Term													
Full Simulation Period ^b		0.00	0.01	-0.01	-0.03	-0.03	-0.01	0.00	0.00	0.00	0.02	0.01	0.00
Water Year Types ^c													
Wet (32%)		-0.01	0.01	0.00	0.01	0.00	0.00	0.00	0.00	-0.01	0.01	-0.01	-0.01
Above Normal (16%)		0.02	0.03	-0.01	-0.02	-0.02	0.00	0.00	0.00	0.00	0.01	0.00	0.00
Below Normal (13%)		0.00	-0.01	0.00	-0.06	-0.10	-0.03	0.00	0.00	0.01	0.02	0.02	0.04
Dry (24%)		-0.01	0.02	0.00	-0.04	-0.05	0.00	0.01	0.00	0.00	0.03	0.03	-0.01
Critical (15%)		0.00	0.00	-0.06	-0.09	-0.04	-0.03	0.00	0.00	0.00	0.01	0.01	0.00

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.25.6. Old River at Rock Slough, Monthly Bromide Concentration

Second Basis of Comparison		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		0.78	0.83	0.85	0.70	0.46	0.19	0.10	0.09	0.12	0.28	0.47	0.64
20%		0.72	0.72	0.75	0.62	0.32	0.13	0.08	0.08	0.08	0.18	0.36	0.60
30%		0.69	0.66	0.73	0.56	0.22	0.10	0.08	0.07	0.07	0.17	0.33	0.57
40%		0.67	0.61	0.70	0.51	0.15	0.08	0.07	0.07	0.07	0.14	0.30	0.54
50%		0.64	0.59	0.61	0.38	0.12	0.07	0.06	0.06	0.06	0.11	0.25	0.53
60%		0.63	0.57	0.55	0.27	0.09	0.07	0.06	0.06	0.06	0.07	0.22	0.51
70%		0.60	0.54	0.46	0.13	0.08	0.06	0.06	0.06	0.05	0.06	0.18	0.50
80%		0.58	0.44	0.32	0.09	0.07	0.06	0.06	0.06	0.05	0.06	0.16	0.45
90%		0.51	0.30	0.12	0.07	0.06	0.05	0.05	0.05	0.05	0.15	0.39	
Long Term													
Full Simulation Period ^b		0.63	0.58	0.56	0.38	0.19	0.10	0.07	0.07	0.08	0.14	0.28	0.52
Water Year Types ^c													
Wet (32%)		0.56	0.52	0.39	0.14	0.09	0.07	0.07	0.06	0.06	0.06	0.16	0.42
Above Normal (16%)		0.70	0.60	0.54	0.35	0.12	0.07	0.06	0.06	0.05	0.07	0.20	0.53
Below Normal (13%)		0.57	0.51	0.57	0.48	0.28	0.12	0.07	0.07	0.06	0.15	0.28	0.53
Dry (24%)		0.65	0.60	0.67	0.51	0.25	0.10	0.07	0.07	0.08	0.19	0.35	0.56
Critical (15%)		0.73	0.71	0.77	0.60	0.31	0.18	0.11	0.12	0.19	0.32	0.48	0.65

Alternative 5		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		0.80	0.83	0.78	0.66	0.31	0.13	0.15	0.16	0.11	0.30	0.50	0.64
20%		0.71	0.68	0.67	0.52	0.27	0.10	0.13	0.15	0.09	0.23	0.45	0.59
30%		0.66	0.58	0.59	0.40	0.19	0.09	0.13	0.14	0.08	0.19	0.37	0.57
40%		0.62	0.52	0.43	0.33	0.14	0.08	0.12	0.13	0.08	0.17	0.31	0.52
50%		0.55	0.40	0.23	0.28	0.12	0.08	0.11	0.12	0.07	0.11	0.26	0.45
60%		0.13	0.14	0.17	0.23	0.10	0.07	0.10	0.11	0.07	0.07	0.22	0.39
70%		0.12	0.06	0.14	0.11	0.08	0.07	0.09	0.10	0.06	0.06	0.20	0.37
80%		0.12	0.06	0.11	0.09	0.08	0.06	0.08	0.09	0.06	0.06	0.18	0.32
90%		0.11	0.05	0.06	0.08	0.07	0.06	0.07	0.05	0.06	0.05	0.16	0.28
Long Term													
Full Simulation Period ^b		0.42	0.38	0.37	0.31	0.17	0.10	0.11	0.12	0.08	0.16	0.30	0.46
Water Year Types ^c													
Wet (32%)		0.30	0.25	0.19	0.13	0.10	0.07	0.08	0.08	0.06	0.06	0.17	0.33
Above Normal (16%)		0.56	0.48	0.37	0.26	0.12	0.07	0.10	0.11	0.07	0.08	0.20	0.29
Below Normal (13%)		0.30	0.26	0.33	0.33	0.16	0.09	0.12	0.13	0.08	0.16	0.28	0.57
Dry (24%)		0.42	0.41	0.44	0.44	0.21	0.10	0.13	0.14	0.08	0.24	0.43	0.55
Critical (15%)		0.62	0.63	0.66	0.54	0.30	0.17	0.16	0.16	0.16	0.30	0.50	0.64

Alternative 5 minus Second Basis of Comparison		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		0.02	0.00	-0.07	-0.05	-0.15	-0.06	0.05	0.07	-0.01	0.02	0.03	0.00
20%		-0.01	-0.03	-0.07	-0.10	-0.05	-0.03	0.05	0.07	0.01	0.05	0.09	-0.01
30%		-0.02	-0.08	-0.14	-0.16	-0.03	-0.01	0.05	0.07	0.01	0.02	0.04	0.00
40%		-0.04	-0.10	-0.27	-0.18	-0.01	0.01	0.05	0.06	0.01	0.02	0.01	-0.01
50%		-0.09	-0.19	-0.38	-0.10	0.00	0.01	0.04	0.06	0.01	0.00	0.01	-0.07
60%		-0.50	-0.43	-0.38	-0.04	0.02	0.01	0.04	0.05	0.01	0.00	0.00	-0.12
70%		-0.48	-0.48	-0.33	-0.02	0.00	0.01	0.03	0.04	0.01	0.00	0.01	-0.14
80%		-0.46	-0.38	-0.21	0.00	0.00	0.00	0.03	0.04	0.01	0.00	0.01	-0.14
90%		-0.40	-0.24	-0.06	0.01	0.01	0.01	0.01	0.00	0.01	0.00	0.01	-0.11
Long Term													
Full Simulation Period ^b		-0.21	-0.20	-0.20	-0.06	-0.02	0.00	0.04	0.05	0.00	0.01	0.03	-0.06
Water Year Types ^c													
Wet (32%)		-0.26	-0.27	-0.20	-0.01	0.01	0.00	0.01	0.02	0.01	0.00	0.01	-0.09
Above Normal (16%)		-0.14	-0.11	-0.18	-0.09	-0.01	0.01	0.04	0.05	0.01	0.00	0.00	-0.23
Below Normal (13%)		-0.27	-0.25	-0.25	-0.15	-0.12	-0.03	0.05	0.06	0.01	0.00	0.00	0.04
Dry (24%)		-0.22	-0.19	-0.22	-0.07	-0.04	0.01	0.06	0.07	0.00	0.06	0.08	-0.01
Critical (15%)		-0.10	-0.08	-0.11	-0.07	-0.01	-0.01	0.05	0.04	-0.02	-0.01	0.02	-0.01

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1 **B.26. Contra Costa Water District Old River Intake Bromide**
2 **Concentration**

3

Table 6E.B.26.1. Contra Costa Water District Old River Intake, Monthly Bromide Concentration

No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.63	0.69	0.70	0.61	0.38	0.30	0.17	0.15	0.13	0.25	0.41	0.52
20%	0.59	0.55	0.60	0.52	0.32	0.15	0.15	0.14	0.11	0.19	0.35	0.49
30%	0.54	0.49	0.51	0.42	0.27	0.13	0.13	0.14	0.10	0.16	0.30	0.44
40%	0.51	0.45	0.40	0.35	0.22	0.12	0.12	0.13	0.09	0.15	0.25	0.41
50%	0.48	0.37	0.25	0.33	0.16	0.11	0.11	0.12	0.09	0.10	0.23	0.37
60%	0.17	0.16	0.19	0.28	0.14	0.10	0.09	0.11	0.09	0.08	0.19	0.35
70%	0.16	0.08	0.13	0.15	0.11	0.10	0.09	0.11	0.08	0.07	0.17	0.32
80%	0.15	0.07	0.09	0.12	0.11	0.09	0.08	0.09	0.08	0.07	0.16	0.28
90%	0.14	0.07	0.08	0.10	0.09	0.08	0.05	0.04	0.07	0.07	0.14	0.26
Long Term												
Full Simulation Period ^b	0.36	0.33	0.34	0.33	0.22	0.14	0.11	0.12	0.10	0.14	0.25	0.38
Water Year Types ^c												
Wet (32%)	0.28	0.23	0.19	0.17	0.12	0.09	0.07	0.08	0.08	0.07	0.15	0.30
Above Normal (16%)	0.46	0.42	0.36	0.30	0.17	0.10	0.10	0.11	0.09	0.07	0.17	0.27
Below Normal (13%)	0.29	0.23	0.29	0.34	0.23	0.13	0.13	0.14	0.10	0.14	0.24	0.46
Dry (24%)	0.36	0.36	0.39	0.43	0.28	0.16	0.13	0.13	0.10	0.19	0.34	0.44
Critical (15%)	0.51	0.52	0.57	0.52	0.36	0.27	0.18	0.16	0.18	0.26	0.40	0.50

Alternative 1												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.63	0.69	0.72	0.64	0.46	0.24	0.13	0.12	0.13	0.24	0.38	0.51
20%	0.60	0.59	0.64	0.58	0.37	0.17	0.11	0.11	0.10	0.17	0.30	0.49
30%	0.57	0.55	0.62	0.53	0.26	0.14	0.10	0.10	0.09	0.15	0.28	0.46
40%	0.56	0.52	0.58	0.50	0.18	0.11	0.09	0.08	0.08	0.12	0.25	0.44
50%	0.54	0.49	0.53	0.42	0.14	0.10	0.08	0.08	0.08	0.08	0.21	0.42
60%	0.53	0.48	0.48	0.30	0.12	0.09	0.08	0.08	0.07	0.07	0.19	0.41
70%	0.50	0.46	0.43	0.16	0.11	0.08	0.08	0.07	0.07	0.07	0.16	0.40
80%	0.49	0.40	0.29	0.11	0.09	0.07	0.07	0.07	0.07	0.07	0.15	0.37
90%	0.44	0.29	0.10	0.09	0.08	0.07	0.06	0.07	0.06	0.07	0.14	0.33
Long Term												
Full Simulation Period ^b	0.52	0.49	0.49	0.37	0.21	0.13	0.10	0.09	0.10	0.13	0.23	0.42
Water Year Types ^c												
Wet (32%)	0.47	0.44	0.36	0.17	0.10	0.09	0.07	0.07	0.07	0.07	0.14	0.35
Above Normal (16%)	0.57	0.51	0.48	0.36	0.15	0.09	0.08	0.07	0.07	0.07	0.17	0.43
Below Normal (13%)	0.49	0.44	0.49	0.45	0.31	0.16	0.10	0.09	0.07	0.14	0.24	0.43
Dry (24%)	0.54	0.51	0.57	0.48	0.27	0.13	0.10	0.10	0.09	0.16	0.30	0.46
Critical (15%)	0.60	0.59	0.65	0.57	0.35	0.24	0.16	0.14	0.20	0.26	0.39	0.52

Alternative 1 minus No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.00	0.00	0.02	0.03	0.07	-0.06	-0.04	-0.04	0.00	-0.01	-0.03	0.00
20%	0.01	0.04	0.04	0.06	0.05	0.02	-0.03	-0.03	-0.01	-0.02	-0.06	0.01
30%	0.03	0.07	0.11	0.11	-0.01	0.01	-0.04	-0.04	-0.01	-0.01	-0.02	0.02
40%	0.05	0.07	0.18	0.14	-0.04	-0.01	-0.03	-0.04	-0.01	-0.03	0.00	0.03
50%	0.06	0.12	0.28	0.09	-0.03	-0.01	-0.03	-0.04	-0.01	-0.02	-0.01	0.06
60%	0.36	0.32	0.29	0.01	-0.02	-0.01	-0.01	-0.04	-0.01	0.00	0.00	0.07
70%	0.35	0.38	0.30	0.01	0.00	-0.02	-0.01	-0.03	-0.02	0.00	-0.01	0.08
80%	0.34	0.33	0.20	-0.01	-0.02	-0.01	0.00	-0.02	-0.01	0.00	-0.01	0.09
90%	0.30	0.22	0.02	-0.02	-0.01	-0.01	0.01	0.02	-0.01	0.00	0.00	0.06
Long Term												
Full Simulation Period ^b	0.16	0.16	0.15	0.04	0.00	-0.01	-0.02	-0.03	-0.01	-0.01	-0.02	0.04
Water Year Types ^c												
Wet (32%)	0.19	0.22	0.17	-0.01	-0.02	0.00	0.00	-0.01	-0.01	0.00	-0.01	0.05
Above Normal (16%)	0.12	0.09	0.12	0.06	-0.02	-0.01	-0.02	-0.04	-0.02	0.00	0.00	0.16
Below Normal (13%)	0.19	0.20	0.19	0.11	0.08	0.02	-0.03	-0.05	-0.02	0.00	0.00	-0.03
Dry (24%)	0.17	0.15	0.18	0.05	-0.01	-0.04	-0.03	-0.03	0.00	-0.04	-0.05	0.02
Critical (15%)	0.09	0.07	0.09	0.05	-0.01	-0.03	-0.02	-0.02	0.02	0.00	-0.01	0.02

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.26.2. Contra Costa Water District Old River Intake, Monthly Bromide Concentration

No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.63	0.69	0.70	0.61	0.38	0.30	0.17	0.15	0.13	0.25	0.41	0.52
20%	0.59	0.55	0.60	0.52	0.32	0.15	0.15	0.14	0.11	0.19	0.35	0.49
30%	0.54	0.49	0.51	0.42	0.27	0.13	0.13	0.14	0.10	0.16	0.30	0.44
40%	0.51	0.45	0.40	0.35	0.22	0.12	0.12	0.13	0.09	0.15	0.25	0.41
50%	0.48	0.37	0.25	0.33	0.16	0.11	0.11	0.12	0.09	0.10	0.23	0.37
60%	0.17	0.16	0.19	0.28	0.14	0.10	0.09	0.11	0.09	0.08	0.19	0.35
70%	0.16	0.08	0.13	0.15	0.11	0.10	0.09	0.11	0.08	0.07	0.17	0.32
80%	0.15	0.07	0.09	0.12	0.11	0.09	0.08	0.09	0.08	0.07	0.16	0.28
90%	0.14	0.07	0.08	0.10	0.09	0.08	0.05	0.04	0.07	0.07	0.14	0.26
Long Term												
Full Simulation Period ^b	0.36	0.33	0.34	0.33	0.22	0.14	0.11	0.12	0.10	0.14	0.25	0.38
Water Year Types^c												
Wet (32%)	0.28	0.23	0.19	0.17	0.12	0.09	0.07	0.08	0.08	0.07	0.15	0.30
Above Normal (16%)	0.46	0.42	0.36	0.30	0.17	0.10	0.10	0.11	0.09	0.07	0.17	0.27
Below Normal (13%)	0.29	0.23	0.29	0.34	0.23	0.13	0.13	0.14	0.10	0.14	0.24	0.46
Dry (24%)	0.36	0.36	0.39	0.43	0.28	0.16	0.13	0.13	0.10	0.19	0.34	0.44
Critical (15%)	0.51	0.52	0.57	0.52	0.36	0.27	0.18	0.16	0.18	0.26	0.40	0.50

Alternative 3												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.63	0.68	0.71	0.61	0.39	0.17	0.15	0.14	0.13	0.28	0.41	0.53
20%	0.60	0.60	0.65	0.57	0.32	0.14	0.13	0.11	0.09	0.18	0.34	0.49
30%	0.57	0.55	0.60	0.50	0.28	0.13	0.12	0.09	0.08	0.17	0.27	0.46
40%	0.56	0.51	0.57	0.46	0.19	0.12	0.11	0.09	0.08	0.14	0.26	0.45
50%	0.54	0.49	0.53	0.43	0.14	0.11	0.09	0.08	0.07	0.11	0.23	0.43
60%	0.52	0.48	0.49	0.26	0.13	0.10	0.08	0.07	0.07	0.08	0.19	0.41
70%	0.50	0.47	0.44	0.15	0.11	0.09	0.08	0.07	0.07	0.07	0.16	0.40
80%	0.48	0.42	0.30	0.13	0.10	0.08	0.08	0.07	0.06	0.07	0.15	0.36
90%	0.43	0.33	0.10	0.09	0.08	0.07	0.07	0.06	0.06	0.07	0.13	0.32
Long Term												
Full Simulation Period ^b	0.52	0.50	0.49	0.36	0.21	0.13	0.10	0.09	0.09	0.14	0.24	0.42
Water Year Types^c												
Wet (32%)	0.46	0.45	0.36	0.19	0.11	0.09	0.07	0.06	0.06	0.07	0.14	0.33
Above Normal (16%)	0.59	0.53	0.48	0.37	0.16	0.09	0.08	0.07	0.07	0.07	0.17	0.43
Below Normal (13%)	0.49	0.43	0.49	0.43	0.25	0.13	0.11	0.09	0.08	0.16	0.25	0.47
Dry (24%)	0.53	0.52	0.57	0.47	0.26	0.15	0.12	0.10	0.08	0.19	0.32	0.45
Critical (15%)	0.59	0.59	0.61	0.50	0.34	0.23	0.17	0.15	0.19	0.27	0.39	0.52

Alternative 3 minus No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.01	-0.02	0.00	0.00	0.01	-0.13	-0.02	-0.02	0.00	0.03	0.00	0.02
20%	0.02	0.05	0.05	0.04	0.00	-0.01	-0.02	-0.03	-0.02	-0.01	-0.02	0.01
30%	0.03	0.06	0.10	0.08	0.01	-0.01	-0.01	-0.04	-0.01	0.01	-0.02	0.02
40%	0.04	0.06	0.17	0.11	-0.03	0.00	-0.02	-0.04	-0.02	-0.01	0.01	0.04
50%	0.06	0.12	0.28	0.11	-0.02	0.00	-0.02	-0.04	-0.02	0.01	0.00	0.06
60%	0.35	0.32	0.30	-0.02	-0.01	-0.01	-0.01	-0.04	-0.02	0.00	0.00	0.07
70%	0.35	0.39	0.31	0.00	0.00	-0.01	-0.01	-0.04	-0.02	0.00	-0.01	0.08
80%	0.34	0.35	0.21	0.01	-0.01	-0.01	0.00	-0.02	-0.02	0.00	-0.01	0.08
90%	0.30	0.26	0.03	-0.01	-0.01	-0.01	0.01	0.02	-0.01	0.00	-0.01	0.06
Long Term												
Full Simulation Period ^b	0.16	0.17	0.15	0.03	-0.01	-0.01	-0.01	-0.03	-0.01	0.00	-0.01	0.04
Water Year Types^c												
Wet (32%)	0.18	0.22	0.17	0.01	-0.01	-0.01	0.00	-0.01	-0.01	0.00	-0.02	0.04
Above Normal (16%)	0.13	0.11	0.13	0.07	-0.01	-0.01	-0.02	-0.04	-0.02	0.00	0.00	0.16
Below Normal (13%)	0.19	0.20	0.20	0.09	0.01	-0.01	-0.02	-0.04	-0.02	0.02	0.01	0.01
Dry (24%)	0.17	0.17	0.18	0.04	-0.02	-0.02	-0.01	-0.03	-0.01	-0.01	-0.02	0.01
Critical (15%)	0.09	0.07	0.04	-0.02	-0.02	-0.04	-0.01	-0.01	0.01	0.00	0.00	0.02

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.26.3. Contra Costa Water District Old River Intake, Monthly Bromide Concentration

No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.63	0.69	0.70	0.61	0.38	0.30	0.17	0.15	0.13	0.25	0.41	0.52
20%	0.59	0.55	0.60	0.52	0.32	0.15	0.15	0.14	0.11	0.19	0.35	0.49
30%	0.54	0.49	0.51	0.42	0.27	0.13	0.13	0.14	0.10	0.16	0.30	0.44
40%	0.51	0.45	0.40	0.35	0.22	0.12	0.12	0.13	0.09	0.15	0.25	0.41
50%	0.48	0.37	0.25	0.33	0.16	0.11	0.11	0.12	0.09	0.10	0.23	0.37
60%	0.17	0.16	0.19	0.28	0.14	0.10	0.09	0.11	0.09	0.08	0.19	0.35
70%	0.16	0.08	0.13	0.15	0.11	0.10	0.09	0.11	0.08	0.07	0.17	0.32
80%	0.15	0.07	0.09	0.12	0.11	0.09	0.08	0.09	0.08	0.07	0.16	0.28
90%	0.14	0.07	0.08	0.10	0.09	0.08	0.05	0.04	0.07	0.07	0.14	0.26
Long Term												
Full Simulation Period ^b	0.36	0.33	0.34	0.33	0.22	0.14	0.11	0.12	0.10	0.14	0.25	0.38
Water Year Types^c												
Wet (32%)	0.28	0.23	0.19	0.17	0.12	0.09	0.07	0.08	0.08	0.07	0.15	0.30
Above Normal (16%)	0.46	0.42	0.36	0.30	0.17	0.10	0.10	0.11	0.09	0.07	0.17	0.27
Below Normal (13%)	0.29	0.23	0.29	0.34	0.23	0.13	0.13	0.14	0.10	0.14	0.24	0.46
Dry (24%)	0.36	0.36	0.39	0.43	0.28	0.16	0.13	0.13	0.10	0.19	0.34	0.44
Critical (15%)	0.51	0.52	0.57	0.52	0.36	0.27	0.18	0.16	0.18	0.26	0.40	0.50

Alternative 5												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.64	0.69	0.70	0.62	0.39	0.30	0.19	0.18	0.15	0.26	0.41	0.52
20%	0.59	0.57	0.59	0.53	0.32	0.15	0.17	0.18	0.12	0.20	0.37	0.49
30%	0.55	0.50	0.51	0.42	0.27	0.13	0.15	0.16	0.11	0.17	0.32	0.46
40%	0.52	0.44	0.41	0.35	0.22	0.12	0.13	0.14	0.10	0.15	0.25	0.43
50%	0.47	0.38	0.24	0.33	0.16	0.11	0.11	0.12	0.09	0.10	0.23	0.37
60%	0.17	0.16	0.19	0.28	0.14	0.10	0.09	0.11	0.09	0.08	0.19	0.35
70%	0.16	0.08	0.13	0.15	0.12	0.10	0.09	0.11	0.09	0.07	0.17	0.33
80%	0.15	0.07	0.09	0.12	0.10	0.09	0.07	0.09	0.08	0.07	0.16	0.29
90%	0.10	0.07	0.08	0.10	0.09	0.08	0.05	0.04	0.07	0.07	0.14	0.25
Long Term												
Full Simulation Period ^b	0.37	0.33	0.34	0.33	0.22	0.14	0.12	0.12	0.10	0.14	0.25	0.38
Water Year Types^c												
Wet (32%)	0.28	0.23	0.20	0.17	0.12	0.09	0.07	0.07	0.08	0.07	0.15	0.30
Above Normal (16%)	0.47	0.42	0.35	0.30	0.17	0.10	0.10	0.11	0.09	0.07	0.17	0.27
Below Normal (13%)	0.29	0.24	0.29	0.34	0.23	0.13	0.12	0.14	0.11	0.14	0.24	0.46
Dry (24%)	0.37	0.35	0.39	0.44	0.28	0.17	0.15	0.16	0.11	0.21	0.36	0.46
Critical (15%)	0.51	0.52	0.56	0.52	0.36	0.27	0.19	0.18	0.15	0.26	0.40	0.51

Alternative 5 minus No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.01	0.00	-0.01	0.00	0.00	0.00	0.01	0.03	0.02	0.01	0.00	0.00
20%	0.01	0.02	-0.01	0.01	0.00	0.00	0.02	0.03	0.01	0.01	0.02	0.01
30%	0.01	0.01	0.00	0.00	0.00	0.00	0.01	0.02	0.01	0.01	0.02	0.01
40%	0.01	-0.01	0.01	0.00	0.00	0.00	0.00	0.01	0.01	0.00	0.00	0.02
50%	0.00	0.01	0.00	0.00	-0.01	0.00	0.00	0.00	0.01	0.00	0.00	0.01
60%	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
70%	0.00	0.00	0.00	0.00	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.01
80%	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01
90%	-0.04	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	-0.01
Long Term												
Full Simulation Period ^b	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.00	0.00	0.01	0.01
Water Year Types^c												
Wet (32%)	0.00	0.01	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Above Normal (16%)	0.01	0.00	-0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Below Normal (13%)	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.00	0.00	0.01
Dry (24%)	0.00	0.00	0.00	0.01	0.00	0.00	0.01	0.03	0.02	0.01	0.02	0.02
Critical (15%)	0.00	0.00	0.00	0.00	0.01	0.01	0.01	0.02	-0.03	-0.01	0.01	0.01

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.26.4. Contra Costa Water District Old River Intake, Monthly Bromide Concentration

Second Basis of Comparison

Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.63	0.69	0.72	0.64	0.46	0.24	0.13	0.12	0.13	0.24	0.38	0.51
20%	0.60	0.59	0.64	0.58	0.37	0.17	0.11	0.11	0.10	0.17	0.30	0.49
30%	0.57	0.55	0.62	0.53	0.26	0.14	0.10	0.10	0.09	0.15	0.28	0.46
40%	0.56	0.52	0.58	0.50	0.18	0.11	0.09	0.08	0.08	0.12	0.25	0.44
50%	0.54	0.49	0.53	0.42	0.14	0.10	0.08	0.08	0.08	0.08	0.21	0.42
60%	0.53	0.48	0.48	0.30	0.12	0.09	0.08	0.08	0.07	0.07	0.19	0.41
70%	0.50	0.46	0.43	0.16	0.11	0.08	0.08	0.07	0.07	0.07	0.16	0.40
80%	0.49	0.40	0.29	0.11	0.09	0.07	0.07	0.07	0.07	0.07	0.15	0.37
90%	0.44	0.29	0.10	0.09	0.08	0.07	0.06	0.07	0.06	0.07	0.14	0.33
Long Term												
Full Simulation Period ^b	0.52	0.49	0.49	0.37	0.21	0.13	0.10	0.09	0.10	0.13	0.23	0.42
Water Year Types ^c												
Wet (32%)	0.47	0.44	0.36	0.17	0.10	0.09	0.07	0.07	0.07	0.07	0.14	0.35
Above Normal (16%)	0.57	0.51	0.48	0.36	0.15	0.09	0.08	0.07	0.07	0.07	0.17	0.43
Below Normal (13%)	0.49	0.44	0.49	0.45	0.31	0.16	0.10	0.09	0.07	0.14	0.24	0.43
Dry (24%)	0.54	0.51	0.57	0.48	0.27	0.13	0.10	0.10	0.09	0.16	0.30	0.46
Critical (15%)	0.60	0.59	0.65	0.57	0.35	0.24	0.16	0.14	0.20	0.26	0.39	0.52

No Action Alternative

Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.63	0.69	0.70	0.61	0.38	0.30	0.17	0.15	0.13	0.25	0.41	0.52
20%	0.59	0.55	0.60	0.52	0.32	0.15	0.15	0.14	0.11	0.19	0.35	0.49
30%	0.54	0.49	0.51	0.42	0.27	0.13	0.13	0.14	0.10	0.16	0.30	0.44
40%	0.51	0.45	0.40	0.35	0.22	0.12	0.12	0.13	0.09	0.15	0.25	0.41
50%	0.48	0.37	0.25	0.33	0.16	0.11	0.11	0.12	0.09	0.10	0.23	0.37
60%	0.17	0.16	0.19	0.28	0.14	0.10	0.09	0.11	0.09	0.08	0.19	0.35
70%	0.16	0.08	0.13	0.15	0.11	0.10	0.09	0.11	0.08	0.07	0.17	0.32
80%	0.15	0.07	0.09	0.12	0.11	0.09	0.08	0.09	0.08	0.07	0.16	0.28
90%	0.14	0.07	0.08	0.10	0.09	0.08	0.05	0.04	0.07	0.07	0.14	0.26
Long Term												
Full Simulation Period ^b	0.36	0.33	0.34	0.33	0.22	0.14	0.11	0.12	0.10	0.14	0.25	0.38
Water Year Types ^c												
Wet (32%)	0.28	0.23	0.19	0.17	0.12	0.09	0.07	0.08	0.08	0.07	0.15	0.30
Above Normal (16%)	0.46	0.42	0.36	0.30	0.17	0.10	0.10	0.11	0.09	0.07	0.17	0.27
Below Normal (13%)	0.29	0.23	0.29	0.34	0.23	0.13	0.13	0.14	0.10	0.14	0.24	0.46
Dry (24%)	0.36	0.36	0.39	0.43	0.28	0.16	0.13	0.13	0.10	0.19	0.34	0.44
Critical (15%)	0.51	0.52	0.57	0.52	0.36	0.27	0.18	0.16	0.18	0.26	0.40	0.50

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.00	0.00	-0.02	-0.03	-0.07	0.06	0.04	0.04	0.00	0.01	0.03	0.00
20%	-0.01	-0.04	-0.04	-0.06	-0.05	-0.02	0.03	0.03	0.01	0.02	0.06	-0.01
30%	-0.03	-0.07	-0.11	-0.11	0.01	-0.01	0.04	0.04	0.01	0.01	0.02	-0.02
40%	-0.05	-0.07	-0.18	-0.14	0.04	0.01	0.03	0.04	0.01	0.03	0.00	-0.03
50%	-0.06	-0.12	-0.28	-0.09	0.03	0.01	0.03	0.04	0.01	0.02	0.01	-0.06
60%	-0.36	-0.32	-0.29	-0.01	0.02	0.01	0.01	0.04	0.01	0.00	0.00	-0.07
70%	-0.35	-0.38	-0.30	-0.01	0.00	0.02	0.01	0.03	0.02	0.00	0.01	-0.08
80%	-0.34	-0.33	-0.20	0.01	0.02	0.01	0.00	0.02	0.01	0.00	0.01	-0.09
90%	-0.30	-0.22	-0.02	0.02	0.01	0.01	-0.01	-0.02	0.01	0.00	0.00	-0.06
Long Term												
Full Simulation Period ^b	-0.16	-0.16	-0.15	-0.04	0.00	0.01	0.02	0.03	0.01	0.01	0.02	-0.04
Water Year Types ^c												
Wet (32%)	-0.19	-0.22	-0.17	0.01	0.02	0.00	0.00	0.01	0.01	0.00	0.01	-0.05
Above Normal (16%)	-0.12	-0.09	-0.12	-0.06	0.02	0.01	0.02	0.04	0.02	0.00	0.00	-0.16
Below Normal (13%)	-0.19	-0.20	-0.19	-0.11	-0.08	-0.02	0.03	0.05	0.02	0.00	0.00	0.03
Dry (24%)	-0.17	-0.15	-0.18	-0.05	0.01	0.04	0.03	0.03	0.00	0.04	0.05	-0.02
Critical (15%)	-0.09	-0.07	-0.09	-0.05	0.01	0.03	0.02	0.02	-0.02	0.00	0.01	-0.02

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.26.5. Contra Costa Water District Old River Intake, Monthly Bromide Concentration

Second Basis of Comparison		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a													
10%		0.63	0.69	0.72	0.64	0.46	0.24	0.13	0.12	0.13	0.24	0.38	0.51
20%		0.60	0.59	0.64	0.58	0.37	0.17	0.11	0.11	0.10	0.17	0.30	0.49
30%		0.57	0.55	0.62	0.53	0.26	0.14	0.10	0.10	0.09	0.15	0.28	0.46
40%		0.56	0.52	0.58	0.50	0.18	0.11	0.09	0.08	0.08	0.12	0.25	0.44
50%		0.54	0.49	0.53	0.42	0.14	0.10	0.08	0.08	0.08	0.08	0.21	0.42
60%		0.53	0.48	0.48	0.30	0.12	0.09	0.08	0.08	0.07	0.07	0.19	0.41
70%		0.50	0.46	0.43	0.16	0.11	0.08	0.08	0.07	0.07	0.07	0.16	0.40
80%		0.49	0.40	0.29	0.11	0.09	0.07	0.07	0.07	0.07	0.07	0.15	0.37
90%		0.44	0.29	0.10	0.09	0.08	0.07	0.06	0.07	0.06	0.07	0.14	0.33
Long Term													
Full Simulation Period ^b		0.52	0.49	0.49	0.37	0.21	0.13	0.10	0.09	0.10	0.13	0.23	0.42
Water Year Types^c													
Wet (32%)		0.47	0.44	0.36	0.17	0.10	0.09	0.07	0.07	0.07	0.07	0.14	0.35
Above Normal (16%)		0.57	0.51	0.48	0.36	0.15	0.09	0.08	0.07	0.07	0.07	0.17	0.43
Below Normal (13%)		0.49	0.44	0.49	0.45	0.31	0.16	0.10	0.09	0.07	0.14	0.24	0.43
Dry (24%)		0.54	0.51	0.57	0.48	0.27	0.13	0.10	0.10	0.09	0.16	0.30	0.46
Critical (15%)		0.60	0.59	0.65	0.57	0.35	0.24	0.16	0.14	0.20	0.26	0.39	0.52

Alternative 3		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a													
10%		0.63	0.68	0.71	0.61	0.39	0.17	0.15	0.14	0.13	0.28	0.41	0.53
20%		0.60	0.60	0.65	0.57	0.32	0.14	0.13	0.11	0.09	0.18	0.34	0.49
30%		0.57	0.55	0.60	0.50	0.28	0.13	0.12	0.09	0.08	0.17	0.27	0.46
40%		0.56	0.51	0.57	0.46	0.19	0.12	0.11	0.09	0.08	0.14	0.26	0.45
50%		0.54	0.49	0.53	0.43	0.14	0.11	0.09	0.08	0.07	0.11	0.23	0.43
60%		0.52	0.48	0.49	0.26	0.13	0.10	0.08	0.07	0.07	0.08	0.19	0.41
70%		0.50	0.47	0.44	0.15	0.11	0.09	0.08	0.07	0.07	0.07	0.16	0.40
80%		0.48	0.42	0.30	0.13	0.10	0.08	0.08	0.07	0.06	0.07	0.15	0.36
90%		0.43	0.33	0.10	0.09	0.08	0.07	0.07	0.06	0.06	0.07	0.13	0.32
Long Term													
Full Simulation Period ^b		0.52	0.50	0.49	0.36	0.21	0.13	0.10	0.09	0.09	0.14	0.24	0.42
Water Year Types^c													
Wet (32%)		0.46	0.45	0.36	0.19	0.11	0.09	0.07	0.06	0.06	0.07	0.14	0.33
Above Normal (16%)		0.59	0.53	0.48	0.37	0.16	0.09	0.08	0.07	0.07	0.07	0.17	0.43
Below Normal (13%)		0.49	0.43	0.49	0.43	0.25	0.13	0.11	0.09	0.08	0.16	0.25	0.47
Dry (24%)		0.53	0.52	0.57	0.47	0.26	0.15	0.12	0.10	0.08	0.19	0.32	0.45
Critical (15%)		0.59	0.59	0.61	0.50	0.34	0.23	0.17	0.15	0.19	0.27	0.39	0.52

Alternative 3 minus Second Basis of Comparison		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a													
10%		0.00	-0.01	-0.02	-0.04	-0.07	-0.06	0.02	0.02	0.00	0.04	0.03	0.02
20%		0.01	0.01	0.01	-0.02	-0.04	-0.03	0.02	0.00	-0.01	0.02	0.04	0.00
30%		-0.01	0.00	-0.02	-0.03	0.02	-0.02	0.02	0.00	0.00	0.02	0.00	0.00
40%		0.00	-0.01	-0.01	-0.03	0.01	0.01	0.02	0.00	0.00	0.02	0.01	0.01
50%		0.00	0.00	0.00	0.01	0.00	0.01	0.01	0.00	0.00	0.02	0.01	0.01
60%		-0.01	0.00	0.01	-0.04	0.01	0.01	0.01	0.00	0.00	0.00	0.00	0.00
70%		0.00	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
80%		0.00	0.02	0.01	0.02	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90%		0.00	0.04	0.00	0.00	0.01	0.00	0.01	0.00	0.00	0.00	-0.01	0.00
Long Term													
Full Simulation Period ^b		0.00	0.01	0.00	-0.01	-0.01	0.00	0.01	0.00	-0.01	0.01	0.01	0.00
Water Year Types^c													
Wet (32%)		-0.01	0.01	0.00	0.02	0.01	0.00	0.00	0.00	-0.01	0.00	-0.01	-0.01
Above Normal (16%)		0.01	0.02	0.00	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Below Normal (13%)		0.00	-0.01	0.00	-0.02	-0.06	-0.03	0.01	0.01	0.01	0.02	0.01	0.04
Dry (24%)		-0.01	0.01	0.00	-0.01	-0.01	0.02	0.02	0.00	-0.01	0.03	0.03	0.00
Critical (15%)		0.00	0.00	-0.04	-0.07	-0.01	-0.01	0.01	0.01	-0.01	0.00	0.01	0.00

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.26.6. Contra Costa Water District Old River Intake, Monthly Bromide Concentration

Second Basis of Comparison

Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.63	0.69	0.72	0.64	0.46	0.24	0.13	0.12	0.13	0.24	0.38	0.51
20%	0.60	0.59	0.64	0.58	0.37	0.17	0.11	0.11	0.10	0.17	0.30	0.49
30%	0.57	0.55	0.62	0.53	0.26	0.14	0.10	0.10	0.09	0.15	0.28	0.46
40%	0.56	0.52	0.58	0.50	0.18	0.11	0.09	0.08	0.08	0.12	0.25	0.44
50%	0.54	0.49	0.53	0.42	0.14	0.10	0.08	0.08	0.08	0.08	0.21	0.42
60%	0.53	0.48	0.48	0.30	0.12	0.09	0.08	0.08	0.07	0.07	0.19	0.41
70%	0.50	0.46	0.43	0.16	0.11	0.08	0.08	0.07	0.07	0.07	0.16	0.40
80%	0.49	0.40	0.29	0.11	0.09	0.07	0.07	0.07	0.07	0.07	0.15	0.37
90%	0.44	0.29	0.10	0.09	0.08	0.07	0.06	0.07	0.06	0.07	0.14	0.33
Long Term												
Full Simulation Period ^b	0.52	0.49	0.49	0.37	0.21	0.13	0.10	0.09	0.10	0.13	0.23	0.42
Water Year Types ^c												
Wet (32%)	0.47	0.44	0.36	0.17	0.10	0.09	0.07	0.07	0.07	0.07	0.14	0.35
Above Normal (16%)	0.57	0.51	0.48	0.36	0.15	0.09	0.08	0.07	0.07	0.07	0.17	0.43
Below Normal (13%)	0.49	0.44	0.49	0.45	0.31	0.16	0.10	0.09	0.07	0.14	0.24	0.43
Dry (24%)	0.54	0.51	0.57	0.48	0.27	0.13	0.10	0.10	0.09	0.16	0.30	0.46
Critical (15%)	0.60	0.59	0.65	0.57	0.35	0.24	0.16	0.14	0.20	0.26	0.39	0.52

Alternative 5

Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.64	0.69	0.70	0.62	0.39	0.30	0.19	0.18	0.15	0.26	0.41	0.52
20%	0.59	0.57	0.59	0.53	0.32	0.15	0.17	0.18	0.12	0.20	0.37	0.49
30%	0.55	0.50	0.51	0.42	0.27	0.13	0.15	0.16	0.11	0.17	0.32	0.46
40%	0.52	0.44	0.41	0.35	0.22	0.12	0.13	0.14	0.10	0.15	0.25	0.43
50%	0.47	0.38	0.24	0.33	0.16	0.11	0.11	0.12	0.09	0.10	0.23	0.37
60%	0.17	0.16	0.19	0.28	0.14	0.10	0.09	0.11	0.09	0.08	0.19	0.35
70%	0.16	0.08	0.13	0.15	0.12	0.10	0.09	0.11	0.09	0.07	0.17	0.33
80%	0.15	0.07	0.09	0.12	0.10	0.09	0.07	0.09	0.08	0.07	0.16	0.29
90%	0.10	0.07	0.08	0.10	0.09	0.08	0.05	0.04	0.07	0.07	0.14	0.25
Long Term												
Full Simulation Period ^b	0.37	0.33	0.34	0.33	0.22	0.14	0.12	0.12	0.10	0.14	0.25	0.38
Water Year Types ^c												
Wet (32%)	0.28	0.23	0.20	0.17	0.12	0.09	0.07	0.07	0.08	0.07	0.15	0.30
Above Normal (16%)	0.47	0.42	0.35	0.30	0.17	0.10	0.10	0.11	0.09	0.07	0.17	0.27
Below Normal (13%)	0.29	0.24	0.29	0.34	0.23	0.13	0.12	0.14	0.11	0.14	0.24	0.46
Dry (24%)	0.37	0.35	0.39	0.44	0.28	0.17	0.15	0.16	0.11	0.21	0.36	0.46
Critical (15%)	0.51	0.52	0.56	0.52	0.36	0.27	0.19	0.18	0.15	0.26	0.40	0.51

Alternative 5 minus Second Basis of Comparison

Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.01	0.00	-0.03	-0.03	-0.07	0.06	0.06	0.06	0.03	0.02	0.03	0.01
20%	0.00	-0.02	-0.06	-0.05	-0.05	-0.02	0.06	0.07	0.02	0.03	0.08	0.00
30%	-0.02	-0.06	-0.11	-0.11	0.01	-0.01	0.05	0.06	0.03	0.02	0.04	-0.01
40%	-0.04	-0.07	-0.17	-0.14	0.04	0.01	0.04	0.05	0.02	0.03	0.00	-0.01
50%	-0.07	-0.11	-0.29	-0.09	0.02	0.01	0.03	0.04	0.02	0.02	0.01	-0.05
60%	-0.36	-0.33	-0.29	-0.01	0.02	0.01	0.01	0.03	0.02	0.00	0.00	-0.06
70%	-0.35	-0.38	-0.30	-0.01	0.01	0.02	0.01	0.03	0.02	0.00	0.01	-0.08
80%	-0.34	-0.33	-0.20	0.01	0.02	0.01	0.00	0.02	0.02	0.00	0.01	-0.08
90%	-0.34	-0.22	-0.02	0.02	0.01	0.01	-0.01	-0.02	0.01	0.00	0.00	-0.07
Long Term												
Full Simulation Period ^b	-0.16	-0.16	-0.15	-0.04	0.00	0.01	0.02	0.03	0.01	0.01	0.02	-0.04
Water Year Types ^c												
Wet (32%)	-0.19	-0.21	-0.16	0.01	0.02	0.00	0.00	0.01	0.01	0.00	0.01	-0.05
Above Normal (16%)	-0.10	-0.09	-0.13	-0.06	0.02	0.01	0.02	0.03	0.02	0.00	0.00	-0.16
Below Normal (13%)	-0.19	-0.20	-0.19	-0.11	-0.08	-0.02	0.03	0.05	0.03	0.00	0.00	0.03
Dry (24%)	-0.17	-0.15	-0.18	-0.05	0.01	0.04	0.05	0.06	0.02	0.05	0.07	0.00
Critical (15%)	-0.09	-0.07	-0.09	-0.05	0.02	0.03	0.03	0.04	-0.05	-0.01	0.02	-0.01

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1 **B.27. Contra Costa Water District Victoria Canal Intake Bromide**
2 **Concentration**

Table 6E.B.27.1. Contra Costa Victoria Canal Intake, Monthly Bromide Concentration

No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.36	0.39	0.46	0.50	0.40	0.21	0.19	0.16	0.13	0.16	0.25	0.30
20%	0.33	0.33	0.39	0.44	0.33	0.19	0.17	0.15	0.12	0.11	0.22	0.28
30%	0.31	0.30	0.35	0.38	0.27	0.18	0.16	0.14	0.11	0.10	0.20	0.27
40%	0.30	0.29	0.31	0.33	0.20	0.16	0.15	0.14	0.11	0.09	0.16	0.25
50%	0.28	0.25	0.20	0.30	0.18	0.15	0.13	0.12	0.11	0.08	0.14	0.24
60%	0.12	0.11	0.13	0.21	0.17	0.14	0.10	0.11	0.11	0.08	0.09	0.23
70%	0.11	0.11	0.10	0.17	0.16	0.12	0.09	0.10	0.10	0.08	0.08	0.22
80%	0.11	0.10	0.09	0.15	0.13	0.10	0.07	0.09	0.10	0.07	0.07	0.19
90%	0.10	0.10	0.08	0.13	0.11	0.09	0.05	0.04	0.09	0.07	0.07	0.18
Long Term												
Full Simulation Period ^b	0.23	0.22	0.24	0.30	0.23	0.16	0.13	0.12	0.11	0.10	0.15	0.23
Water Year Types^c												
Wet (32%)	0.19	0.17	0.16	0.18	0.14	0.10	0.07	0.08	0.09	0.09	0.08	0.20
Above Normal (16%)	0.27	0.27	0.26	0.29	0.21	0.14	0.11	0.11	0.11	0.08	0.08	0.18
Below Normal (13%)	0.19	0.18	0.20	0.30	0.24	0.16	0.14	0.14	0.11	0.08	0.14	0.25
Dry (24%)	0.22	0.23	0.27	0.36	0.26	0.19	0.16	0.14	0.11	0.10	0.22	0.26
Critical (15%)	0.30	0.32	0.38	0.44	0.37	0.27	0.20	0.16	0.15	0.18	0.26	0.31

Alternative 1												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.38	0.40	0.42	0.47	0.39	0.28	0.17	0.15	0.14	0.15	0.23	0.31
20%	0.34	0.33	0.38	0.43	0.35	0.18	0.15	0.14	0.12	0.10	0.19	0.28
30%	0.32	0.32	0.36	0.40	0.27	0.15	0.13	0.13	0.11	0.10	0.18	0.26
40%	0.32	0.31	0.35	0.37	0.17	0.14	0.12	0.11	0.10	0.09	0.16	0.24
50%	0.30	0.29	0.33	0.35	0.16	0.13	0.12	0.10	0.10	0.08	0.14	0.23
60%	0.29	0.28	0.32	0.19	0.14	0.12	0.11	0.10	0.09	0.08	0.09	0.23
70%	0.28	0.26	0.29	0.14	0.13	0.11	0.10	0.09	0.09	0.07	0.08	0.22
80%	0.27	0.24	0.20	0.13	0.11	0.10	0.09	0.09	0.09	0.07	0.08	0.21
90%	0.23	0.21	0.10	0.11	0.10	0.09	0.07	0.06	0.08	0.07	0.07	0.18
Long Term												
Full Simulation Period ^b	0.30	0.29	0.30	0.30	0.21	0.16	0.12	0.11	0.10	0.10	0.14	0.23
Water Year Types^c												
Wet (32%)	0.27	0.25	0.24	0.17	0.11	0.10	0.08	0.07	0.09	0.09	0.08	0.19
Above Normal (16%)	0.33	0.30	0.29	0.29	0.17	0.12	0.11	0.10	0.09	0.07	0.09	0.22
Below Normal (13%)	0.27	0.25	0.28	0.33	0.28	0.19	0.13	0.12	0.09	0.07	0.15	0.24
Dry (24%)	0.31	0.30	0.34	0.36	0.26	0.17	0.13	0.13	0.11	0.10	0.19	0.26
Critical (15%)	0.35	0.37	0.41	0.43	0.33	0.26	0.19	0.15	0.15	0.19	0.26	0.32

Alternative 1 minus No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.01	0.01	-0.04	-0.03	-0.01	0.07	-0.03	-0.01	0.00	-0.01	-0.02	0.01
20%	0.01	0.00	-0.01	-0.01	0.02	-0.01	-0.03	-0.01	0.00	0.00	-0.03	0.00
30%	0.01	0.02	0.02	0.02	0.00	-0.02	-0.03	-0.01	0.00	0.00	-0.02	-0.01
40%	0.02	0.02	0.03	0.04	-0.03	-0.02	-0.02	-0.03	-0.01	0.00	0.01	-0.01
50%	0.03	0.04	0.13	0.06	-0.03	-0.02	-0.02	-0.02	-0.01	0.00	0.00	0.00
60%	0.18	0.17	0.19	-0.02	-0.03	-0.02	0.01	-0.01	-0.01	0.00	0.00	0.00
70%	0.17	0.15	0.19	-0.03	-0.03	-0.01	0.01	-0.01	-0.01	-0.01	0.00	0.00
80%	0.16	0.14	0.10	-0.02	-0.02	0.00	0.01	0.00	-0.01	0.00	0.00	0.02
90%	0.13	0.12	0.01	-0.02	-0.01	0.00	0.01	0.02	-0.01	0.00	0.00	0.01
Long Term												
Full Simulation Period ^b	0.07	0.06	0.06	0.00	-0.01	-0.01	-0.01	-0.01	-0.01	0.00	-0.01	0.00
Water Year Types^c												
Wet (32%)	0.08	0.08	0.08	-0.01	-0.02	0.00	0.01	0.00	-0.01	0.00	0.00	-0.02
Above Normal (16%)	0.06	0.03	0.03	0.01	-0.04	-0.02	0.00	-0.02	-0.01	0.00	0.01	0.05
Below Normal (13%)	0.08	0.07	0.08	0.03	0.04	0.03	-0.01	-0.02	-0.02	-0.01	0.01	-0.01
Dry (24%)	0.09	0.07	0.07	0.00	0.00	-0.02	-0.03	-0.01	0.00	-0.01	-0.03	0.00
Critical (15%)	0.05	0.05	0.02	-0.01	-0.04	-0.02	-0.01	-0.01	0.01	0.00	0.00	0.01

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Second Basis of Comparison and Alternative 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.27.2. Contra Costa Victoria Canal Intake, Monthly Bromide Concentration

No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.36	0.39	0.46	0.50	0.40	0.21	0.19	0.16	0.13	0.16	0.25	0.30
20%	0.33	0.33	0.39	0.44	0.33	0.19	0.17	0.15	0.12	0.11	0.22	0.28
30%	0.31	0.30	0.35	0.38	0.27	0.18	0.16	0.14	0.11	0.10	0.20	0.27
40%	0.30	0.29	0.31	0.33	0.20	0.16	0.15	0.14	0.11	0.09	0.16	0.25
50%	0.28	0.25	0.20	0.30	0.18	0.15	0.13	0.12	0.11	0.08	0.14	0.24
60%	0.12	0.11	0.13	0.21	0.17	0.14	0.10	0.11	0.11	0.08	0.09	0.23
70%	0.11	0.11	0.10	0.17	0.16	0.12	0.09	0.10	0.10	0.08	0.08	0.22
80%	0.11	0.10	0.09	0.15	0.13	0.10	0.07	0.09	0.10	0.07	0.07	0.19
90%	0.10	0.10	0.08	0.13	0.11	0.09	0.05	0.04	0.09	0.07	0.07	0.18
Long Term												
Full Simulation Period ^b	0.23	0.22	0.24	0.30	0.23	0.16	0.13	0.12	0.11	0.10	0.15	0.23
Water Year Types ^c												
Wet (32%)	0.19	0.17	0.16	0.18	0.14	0.10	0.07	0.08	0.09	0.09	0.08	0.20
Above Normal (16%)	0.27	0.27	0.26	0.29	0.21	0.14	0.11	0.11	0.11	0.08	0.08	0.18
Below Normal (13%)	0.19	0.18	0.20	0.30	0.24	0.16	0.14	0.14	0.11	0.08	0.14	0.25
Dry (24%)	0.22	0.23	0.27	0.36	0.26	0.19	0.16	0.14	0.11	0.10	0.22	0.26
Critical (15%)	0.30	0.32	0.38	0.44	0.37	0.27	0.20	0.16	0.15	0.18	0.26	0.31

Alternative 3												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.37	0.40	0.42	0.48	0.40	0.20	0.18	0.15	0.11	0.16	0.26	0.29
20%	0.34	0.34	0.38	0.44	0.36	0.18	0.16	0.13	0.11	0.11	0.21	0.28
30%	0.33	0.32	0.37	0.42	0.21	0.17	0.15	0.12	0.10	0.10	0.19	0.26
40%	0.32	0.31	0.35	0.39	0.18	0.16	0.14	0.10	0.10	0.09	0.17	0.25
50%	0.31	0.29	0.33	0.37	0.17	0.14	0.12	0.10	0.09	0.08	0.14	0.24
60%	0.29	0.28	0.32	0.20	0.15	0.13	0.11	0.09	0.09	0.08	0.09	0.23
70%	0.28	0.26	0.29	0.16	0.14	0.12	0.10	0.09	0.08	0.08	0.08	0.22
80%	0.27	0.24	0.23	0.14	0.12	0.10	0.08	0.08	0.08	0.07	0.07	0.20
90%	0.23	0.22	0.10	0.13	0.10	0.09	0.07	0.06	0.07	0.06	0.07	0.16
Long Term												
Full Simulation Period ^b	0.30	0.29	0.31	0.31	0.21	0.16	0.13	0.10	0.10	0.10	0.15	0.24
Water Year Types ^c												
Wet (32%)	0.27	0.25	0.25	0.19	0.12	0.10	0.08	0.07	0.08	0.09	0.08	0.18
Above Normal (16%)	0.33	0.32	0.30	0.32	0.19	0.13	0.11	0.09	0.09	0.07	0.09	0.22
Below Normal (13%)	0.27	0.25	0.29	0.35	0.24	0.16	0.14	0.11	0.09	0.08	0.16	0.26
Dry (24%)	0.31	0.30	0.35	0.38	0.27	0.19	0.15	0.12	0.09	0.10	0.20	0.26
Critical (15%)	0.35	0.37	0.40	0.39	0.33	0.25	0.19	0.16	0.14	0.19	0.26	0.32

Alternative 3 minus No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.01	0.00	-0.04	-0.02	0.00	-0.01	-0.01	-0.01	-0.02	0.00	0.00	-0.01
20%	0.01	0.00	-0.01	0.00	0.03	-0.01	-0.01	-0.02	-0.02	0.00	-0.01	0.00
30%	0.02	0.01	0.02	0.04	-0.07	-0.01	-0.01	-0.03	-0.01	0.00	-0.01	0.00
40%	0.02	0.02	0.04	0.06	-0.02	-0.01	-0.01	-0.04	-0.01	0.00	0.01	0.01
50%	0.03	0.04	0.13	0.07	-0.02	-0.01	-0.01	-0.02	-0.02	0.00	0.00	0.00
60%	0.17	0.16	0.19	-0.01	-0.02	-0.01	0.01	-0.02	-0.02	0.00	0.01	0.00
70%	0.17	0.15	0.19	-0.01	-0.02	0.00	0.01	-0.02	-0.02	0.00	0.00	0.00
80%	0.16	0.14	0.13	-0.01	-0.02	-0.01	0.01	0.00	-0.02	0.00	0.00	0.01
90%	0.13	0.12	0.02	0.00	-0.01	0.00	0.02	0.02	-0.01	0.00	0.00	-0.01
Long Term												
Full Simulation Period ^b	0.07	0.07	0.07	0.01	-0.01	-0.01	0.00	-0.01	-0.02	0.00	0.00	0.00
Water Year Types ^c												
Wet (32%)	0.08	0.09	0.09	0.01	-0.02	0.00	0.01	-0.01	-0.01	0.00	0.00	-0.02
Above Normal (16%)	0.06	0.05	0.04	0.04	-0.02	-0.01	0.00	-0.02	-0.02	0.00	0.00	0.05
Below Normal (13%)	0.08	0.07	0.09	0.05	0.00	-0.01	-0.01	-0.03	-0.02	0.00	0.01	0.01
Dry (24%)	0.08	0.07	0.08	0.02	0.01	0.00	-0.01	-0.02	-0.02	0.00	-0.02	0.00
Critical (15%)	0.05	0.05	0.01	-0.05	-0.04	-0.02	0.00	0.00	-0.01	0.00	0.00	0.01

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.27.3. Contra Costa Victoria Canal Intake, Monthly Bromide Concentration

No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.36	0.39	0.46	0.50	0.40	0.21	0.19	0.16	0.13	0.16	0.25	0.30
20%	0.33	0.33	0.39	0.44	0.33	0.19	0.17	0.15	0.12	0.11	0.22	0.28
30%	0.31	0.30	0.35	0.38	0.27	0.18	0.16	0.14	0.11	0.10	0.20	0.27
40%	0.30	0.29	0.31	0.33	0.20	0.16	0.15	0.14	0.11	0.09	0.16	0.25
50%	0.28	0.25	0.20	0.30	0.18	0.15	0.13	0.12	0.11	0.08	0.14	0.24
60%	0.12	0.11	0.13	0.21	0.17	0.14	0.10	0.11	0.11	0.08	0.09	0.23
70%	0.11	0.11	0.10	0.17	0.16	0.12	0.09	0.10	0.10	0.08	0.08	0.22
80%	0.11	0.10	0.09	0.15	0.13	0.10	0.07	0.09	0.10	0.07	0.07	0.19
90%	0.10	0.10	0.08	0.13	0.11	0.09	0.05	0.04	0.09	0.07	0.07	0.18
Long Term												
Full Simulation Period ^b	0.23	0.22	0.24	0.30	0.23	0.16	0.13	0.12	0.11	0.10	0.15	0.23
Water Year Types^c												
Wet (32%)	0.19	0.17	0.16	0.18	0.14	0.10	0.07	0.08	0.09	0.09	0.08	0.20
Above Normal (16%)	0.27	0.27	0.26	0.29	0.21	0.14	0.11	0.11	0.11	0.08	0.08	0.18
Below Normal (13%)	0.19	0.18	0.20	0.30	0.24	0.16	0.14	0.14	0.11	0.08	0.14	0.25
Dry (24%)	0.22	0.23	0.27	0.36	0.26	0.19	0.16	0.14	0.11	0.10	0.22	0.26
Critical (15%)	0.30	0.32	0.38	0.44	0.37	0.27	0.20	0.16	0.15	0.18	0.26	0.31

Alternative 5												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.37	0.40	0.46	0.50	0.40	0.21	0.20	0.18	0.16	0.16	0.27	0.30
20%	0.34	0.35	0.39	0.44	0.35	0.19	0.18	0.17	0.14	0.11	0.22	0.28
30%	0.32	0.30	0.35	0.38	0.30	0.17	0.17	0.15	0.13	0.10	0.20	0.27
40%	0.30	0.29	0.30	0.33	0.20	0.16	0.14	0.13	0.12	0.09	0.17	0.25
50%	0.28	0.25	0.21	0.30	0.19	0.15	0.13	0.12	0.11	0.09	0.14	0.24
60%	0.15	0.11	0.13	0.21	0.17	0.14	0.10	0.11	0.11	0.08	0.09	0.23
70%	0.11	0.11	0.10	0.17	0.16	0.12	0.09	0.10	0.11	0.08	0.08	0.22
80%	0.10	0.10	0.09	0.15	0.13	0.10	0.07	0.08	0.10	0.07	0.07	0.19
90%	0.10	0.10	0.08	0.13	0.11	0.09	0.05	0.04	0.09	0.07	0.07	0.17
Long Term												
Full Simulation Period ^b	0.23	0.22	0.24	0.30	0.23	0.16	0.13	0.12	0.12	0.10	0.15	0.24
Water Year Types^c												
Wet (32%)	0.19	0.17	0.17	0.18	0.14	0.10	0.07	0.07	0.09	0.09	0.08	0.20
Above Normal (16%)	0.28	0.27	0.26	0.29	0.21	0.14	0.11	0.11	0.11	0.08	0.08	0.18
Below Normal (13%)	0.20	0.18	0.20	0.30	0.24	0.16	0.14	0.13	0.12	0.08	0.14	0.25
Dry (24%)	0.23	0.23	0.26	0.37	0.27	0.19	0.16	0.15	0.13	0.11	0.23	0.26
Critical (15%)	0.30	0.32	0.38	0.44	0.37	0.28	0.21	0.18	0.16	0.18	0.26	0.31

Alternative 5 minus No Action Alternative												
Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a												
10%	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.02	0.02	0.00	0.01	0.00
20%	0.01	0.01	0.00	0.00	0.02	0.00	0.01	0.02	0.02	0.00	0.01	0.00
30%	0.00	0.00	0.00	0.00	0.03	0.00	0.01	0.01	0.01	0.00	0.00	0.01
40%	0.00	0.00	-0.02	0.00	0.00	0.00	0.00	-0.01	0.01	0.00	0.01	0.01
50%	0.00	0.01	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
60%	0.03	0.00	0.00	0.00	0.00	0.00	0.00	-0.01	0.00	0.00	0.00	0.00
70%	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
80%	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
90%	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Long Term												
Full Simulation Period ^b	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.00	0.00	0.00
Water Year Types^c												
Wet (32%)	0.00	0.00	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Above Normal (16%)	0.01	0.00	0.00	0.00	0.00	0.00	0.00	-0.01	0.00	0.00	0.00	0.00
Below Normal (13%)	0.01	0.00	0.00	0.00	0.00	0.00	-0.01	-0.01	0.01	0.00	0.00	0.00
Dry (24%)	0.00	0.00	0.00	0.00	0.01	0.00	0.01	0.02	0.02	0.01	0.01	0.01
Critical (15%)	0.00	0.00	0.00	0.00	0.00	0.00	0.02	0.02	0.01	-0.01	0.00	0.00

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.27.4. Contra Costa Victoria Canal Intake, Monthly Bromide Concentration

Second Basis of Comparison

Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.38	0.40	0.42	0.47	0.39	0.28	0.17	0.15	0.14	0.15	0.23	0.31
20%	0.34	0.33	0.38	0.43	0.35	0.18	0.15	0.14	0.12	0.10	0.19	0.28
30%	0.32	0.32	0.36	0.40	0.27	0.15	0.13	0.13	0.11	0.10	0.18	0.26
40%	0.32	0.31	0.35	0.37	0.17	0.14	0.12	0.11	0.10	0.09	0.16	0.24
50%	0.30	0.29	0.33	0.35	0.16	0.13	0.12	0.10	0.10	0.08	0.14	0.23
60%	0.29	0.28	0.32	0.19	0.14	0.12	0.11	0.10	0.09	0.08	0.09	0.23
70%	0.28	0.26	0.29	0.14	0.13	0.11	0.10	0.09	0.09	0.07	0.08	0.22
80%	0.27	0.24	0.20	0.13	0.11	0.10	0.09	0.09	0.09	0.07	0.08	0.21
90%	0.23	0.21	0.10	0.11	0.10	0.09	0.07	0.06	0.08	0.07	0.07	0.18
Long Term												
Full Simulation Period ^b	0.30	0.29	0.30	0.30	0.21	0.16	0.12	0.11	0.10	0.10	0.14	0.23
Water Year Types ^c												
Wet (32%)	0.27	0.25	0.24	0.17	0.11	0.10	0.08	0.07	0.09	0.09	0.08	0.19
Above Normal (16%)	0.33	0.30	0.29	0.29	0.17	0.12	0.11	0.10	0.09	0.07	0.09	0.22
Below Normal (13%)	0.27	0.25	0.28	0.33	0.28	0.19	0.13	0.12	0.09	0.07	0.15	0.24
Dry (24%)	0.31	0.30	0.34	0.36	0.26	0.17	0.13	0.13	0.11	0.10	0.19	0.26
Critical (15%)	0.35	0.37	0.41	0.43	0.33	0.26	0.19	0.15	0.15	0.19	0.26	0.32

No Action Alternative

Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	0.36	0.39	0.46	0.50	0.40	0.21	0.19	0.16	0.13	0.16	0.25	0.30
20%	0.33	0.33	0.39	0.44	0.33	0.19	0.17	0.15	0.12	0.11	0.22	0.28
30%	0.31	0.30	0.35	0.38	0.27	0.18	0.16	0.14	0.11	0.10	0.20	0.27
40%	0.30	0.29	0.31	0.33	0.20	0.16	0.15	0.14	0.11	0.09	0.16	0.25
50%	0.28	0.25	0.20	0.30	0.18	0.15	0.13	0.12	0.11	0.08	0.14	0.24
60%	0.12	0.11	0.13	0.21	0.17	0.14	0.10	0.11	0.11	0.08	0.09	0.23
70%	0.11	0.11	0.10	0.17	0.16	0.12	0.09	0.10	0.10	0.08	0.08	0.22
80%	0.11	0.10	0.09	0.15	0.13	0.10	0.07	0.09	0.10	0.07	0.07	0.19
90%	0.10	0.10	0.08	0.13	0.11	0.09	0.05	0.04	0.09	0.07	0.07	0.18
Long Term												
Full Simulation Period ^b	0.23	0.22	0.24	0.30	0.23	0.16	0.13	0.12	0.11	0.10	0.15	0.23
Water Year Types ^c												
Wet (32%)	0.19	0.17	0.16	0.18	0.14	0.10	0.07	0.08	0.09	0.09	0.08	0.20
Above Normal (16%)	0.27	0.27	0.26	0.29	0.21	0.14	0.11	0.11	0.11	0.08	0.08	0.18
Below Normal (13%)	0.19	0.18	0.20	0.30	0.24	0.16	0.14	0.14	0.11	0.08	0.14	0.25
Dry (24%)	0.22	0.23	0.27	0.36	0.26	0.19	0.16	0.14	0.11	0.10	0.22	0.26
Critical (15%)	0.30	0.32	0.38	0.44	0.37	0.27	0.20	0.16	0.15	0.18	0.26	0.31

No Action Alternative minus Second Basis of Comparison

Statistic	Monthly Bromide Concentration (mg/L)											
	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a												
10%	-0.01	-0.01	0.04	0.03	0.01	-0.07	0.03	0.01	0.00	0.01	0.02	-0.01
20%	-0.01	0.00	0.01	0.01	-0.02	0.01	0.03	0.01	0.00	0.00	0.03	0.00
30%	-0.01	-0.02	-0.02	-0.02	0.00	0.02	0.03	0.01	0.00	0.00	0.02	0.01
40%	-0.02	-0.02	-0.03	-0.04	0.03	0.02	0.02	0.03	0.01	0.00	-0.01	0.01
50%	-0.03	-0.04	-0.13	-0.06	0.03	0.02	0.02	0.02	0.01	0.00	0.00	0.00
60%	-0.18	-0.17	-0.19	0.02	0.03	0.02	-0.01	0.01	0.01	0.00	0.00	0.00
70%	-0.17	-0.15	-0.19	0.03	0.03	0.01	-0.01	0.01	0.01	0.01	0.00	0.00
80%	-0.16	-0.14	-0.10	0.02	0.02	0.00	-0.01	0.00	0.01	0.00	0.00	-0.02
90%	-0.13	-0.12	-0.01	0.02	0.01	0.00	-0.01	-0.02	0.01	0.00	0.00	-0.01
Long Term												
Full Simulation Period ^b	-0.07	-0.06	-0.06	0.00	0.01	0.01	0.01	0.01	0.01	0.00	0.01	0.00
Water Year Types ^c												
Wet (32%)	-0.08	-0.08	-0.08	0.01	0.02	0.00	-0.01	0.00	0.01	0.00	0.00	0.02
Above Normal (16%)	-0.06	-0.03	-0.03	-0.01	0.04	0.02	0.00	0.02	0.01	0.00	-0.01	-0.05
Below Normal (13%)	-0.08	-0.07	-0.08	-0.03	-0.04	-0.03	0.01	0.02	0.02	0.01	-0.01	0.01
Dry (24%)	-0.09	-0.07	-0.07	0.00	0.00	0.02	0.03	0.01	0.00	0.01	0.03	0.00
Critical (15%)	-0.05	-0.05	-0.02	0.01	0.04	0.02	0.01	0.01	-0.01	0.00	0.00	-0.01

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.27.5. Contra Costa Victoria Canal Intake, Monthly Bromide Concentration

Second Basis of Comparison		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		0.38	0.40	0.42	0.47	0.39	0.28	0.17	0.15	0.14	0.15	0.23	0.31
20%		0.34	0.33	0.38	0.43	0.35	0.18	0.15	0.14	0.12	0.10	0.19	0.28
30%		0.32	0.32	0.36	0.40	0.27	0.15	0.13	0.13	0.11	0.10	0.18	0.26
40%		0.32	0.31	0.35	0.37	0.17	0.14	0.12	0.11	0.10	0.09	0.16	0.24
50%		0.30	0.29	0.33	0.35	0.16	0.13	0.12	0.10	0.10	0.08	0.14	0.23
60%		0.29	0.28	0.32	0.19	0.14	0.12	0.11	0.10	0.09	0.08	0.09	0.23
70%		0.28	0.26	0.29	0.14	0.13	0.11	0.10	0.09	0.09	0.07	0.08	0.22
80%		0.27	0.24	0.20	0.13	0.11	0.10	0.09	0.09	0.09	0.07	0.08	0.21
90%		0.23	0.21	0.10	0.11	0.10	0.09	0.07	0.06	0.08	0.07	0.07	0.18
Long Term													
Full Simulation Period ^b		0.30	0.29	0.30	0.30	0.21	0.16	0.12	0.11	0.10	0.10	0.14	0.23
Water Year Types ^c													
Wet (32%)		0.27	0.25	0.24	0.17	0.11	0.10	0.08	0.07	0.09	0.09	0.08	0.19
Above Normal (16%)		0.33	0.30	0.29	0.29	0.17	0.12	0.11	0.10	0.09	0.07	0.09	0.22
Below Normal (13%)		0.27	0.25	0.28	0.33	0.28	0.19	0.13	0.12	0.09	0.07	0.15	0.24
Dry (24%)		0.31	0.30	0.34	0.36	0.26	0.17	0.13	0.13	0.11	0.10	0.19	0.26
Critical (15%)		0.35	0.37	0.41	0.43	0.33	0.26	0.19	0.15	0.15	0.19	0.26	0.32

Alternative 3

Alternative 3		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		0.37	0.40	0.42	0.48	0.40	0.20	0.18	0.15	0.11	0.16	0.26	0.29
20%		0.34	0.34	0.38	0.44	0.36	0.18	0.16	0.13	0.11	0.11	0.21	0.28
30%		0.33	0.32	0.37	0.42	0.21	0.17	0.15	0.12	0.10	0.10	0.19	0.26
40%		0.32	0.31	0.35	0.39	0.18	0.16	0.14	0.10	0.10	0.09	0.17	0.25
50%		0.31	0.29	0.33	0.37	0.17	0.14	0.12	0.10	0.09	0.08	0.14	0.24
60%		0.29	0.28	0.32	0.20	0.15	0.13	0.11	0.09	0.09	0.08	0.09	0.23
70%		0.28	0.26	0.29	0.16	0.14	0.12	0.10	0.09	0.08	0.08	0.08	0.22
80%		0.27	0.24	0.23	0.14	0.12	0.10	0.08	0.08	0.08	0.07	0.07	0.20
90%		0.23	0.22	0.10	0.13	0.10	0.09	0.07	0.06	0.07	0.06	0.07	0.16
Long Term													
Full Simulation Period ^b		0.30	0.29	0.31	0.31	0.21	0.16	0.13	0.10	0.10	0.10	0.15	0.24
Water Year Types ^c													
Wet (32%)		0.27	0.25	0.25	0.19	0.12	0.10	0.08	0.07	0.08	0.09	0.08	0.18
Above Normal (16%)		0.33	0.32	0.30	0.32	0.19	0.13	0.11	0.09	0.09	0.07	0.09	0.22
Below Normal (13%)		0.27	0.25	0.29	0.35	0.24	0.16	0.14	0.11	0.09	0.08	0.16	0.26
Dry (24%)		0.31	0.30	0.35	0.38	0.27	0.19	0.15	0.12	0.09	0.10	0.20	0.26
Critical (15%)		0.35	0.37	0.40	0.39	0.33	0.25	0.19	0.16	0.14	0.19	0.26	0.32

Alternative 3 minus Second Basis of Comparison

Alternative 3 minus Second Basis of Comparison		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance ^a													
10%		0.00	0.00	-0.01	0.00	0.01	-0.08	0.01	0.00	-0.03	0.02	0.02	-0.02
20%		0.00	0.01	0.00	0.01	0.01	0.00	0.02	-0.01	-0.01	0.01	0.02	0.00
30%		0.00	0.00	0.00	0.02	-0.06	0.02	0.02	-0.01	-0.01	0.00	0.01	0.01
40%		0.00	0.00	0.00	0.02	0.01	0.02	0.01	-0.01	-0.01	0.00	0.01	0.01
50%		0.00	0.00	0.00	0.02	0.01	0.01	0.00	-0.01	-0.01	0.00	0.00	0.00
60%		0.00	0.00	-0.01	0.01	0.01	0.01	0.00	-0.01	-0.01	0.00	0.00	0.00
70%		0.00	0.00	0.00	0.01	0.01	0.01	0.00	-0.01	-0.01	0.00	0.00	0.00
80%		0.00	0.00	0.03	0.01	0.00	0.00	0.00	0.00	-0.01	0.00	0.00	0.00
90%		0.00	0.00	0.01	0.02	0.00	0.00	0.00	0.00	-0.01	0.00	0.00	-0.02
Long Term													
Full Simulation Period ^b		0.00	0.01	0.01	0.01	0.00	0.00	0.01	0.00	-0.01	0.00	0.01	0.00
Water Year Types ^c													
Wet (32%)		0.00	0.01	0.01	0.02	0.01	0.00	0.00	0.00	-0.01	0.00	0.00	0.00
Above Normal (16%)		0.00	0.02	0.01	0.03	0.02	0.01	0.00	-0.01	-0.01	0.00	0.00	0.00
Below Normal (13%)		-0.01	0.00	0.01	0.02	-0.05	-0.04	0.01	0.00	0.00	0.01	0.00	0.02
Dry (24%)		0.00	0.00	0.01	0.02	0.01	0.02	0.02	-0.01	-0.01	0.01	0.02	0.00
Critical (15%)		0.00	0.00	-0.01	-0.04	0.00	0.00	0.00	0.01	-0.02	0.00	0.00	0.00

a Exceedance probability is defined as the probability a given value will be exceeded in any one year.

b Based on the 82-year simulation period.

c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.

Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

Table 6E.B.27.6. Contra Costa Victoria Canal Intake, Monthly Bromide Concentration

Second Basis of Comparison		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a													
10%		0.38	0.40	0.42	0.47	0.39	0.28	0.17	0.15	0.14	0.15	0.23	0.31
20%		0.34	0.33	0.38	0.43	0.35	0.18	0.15	0.14	0.12	0.10	0.19	0.28
30%		0.32	0.32	0.36	0.40	0.27	0.15	0.13	0.13	0.11	0.10	0.18	0.26
40%		0.32	0.31	0.35	0.37	0.17	0.14	0.12	0.11	0.10	0.09	0.16	0.24
50%		0.30	0.29	0.33	0.35	0.16	0.13	0.12	0.10	0.10	0.08	0.14	0.23
60%		0.29	0.28	0.32	0.19	0.14	0.12	0.11	0.10	0.09	0.08	0.09	0.23
70%		0.28	0.26	0.29	0.14	0.13	0.11	0.10	0.09	0.09	0.07	0.08	0.22
80%		0.27	0.24	0.20	0.13	0.11	0.10	0.09	0.09	0.09	0.07	0.08	0.21
90%		0.23	0.21	0.10	0.11	0.10	0.09	0.07	0.06	0.08	0.07	0.07	0.18
Long Term													
Full Simulation Period ^b		0.30	0.29	0.30	0.30	0.21	0.16	0.12	0.11	0.10	0.10	0.14	0.23
Water Year Types^c													
Wet (32%)		0.27	0.25	0.24	0.17	0.11	0.10	0.08	0.07	0.09	0.09	0.08	0.19
Above Normal (16%)		0.33	0.30	0.29	0.29	0.17	0.12	0.11	0.10	0.09	0.07	0.09	0.22
Below Normal (13%)		0.27	0.25	0.28	0.33	0.28	0.19	0.13	0.12	0.09	0.07	0.15	0.24
Dry (24%)		0.31	0.30	0.34	0.36	0.26	0.17	0.13	0.13	0.11	0.10	0.19	0.26
Critical (15%)		0.35	0.37	0.41	0.43	0.33	0.26	0.19	0.15	0.15	0.19	0.26	0.32

Alternative 5		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a													
10%		0.37	0.40	0.46	0.50	0.40	0.21	0.20	0.18	0.16	0.16	0.27	0.30
20%		0.34	0.35	0.39	0.44	0.35	0.19	0.18	0.17	0.14	0.11	0.22	0.28
30%		0.32	0.30	0.35	0.38	0.30	0.17	0.17	0.15	0.13	0.10	0.20	0.27
40%		0.30	0.29	0.30	0.33	0.20	0.16	0.14	0.13	0.12	0.09	0.17	0.25
50%		0.28	0.25	0.21	0.30	0.19	0.15	0.13	0.12	0.11	0.09	0.14	0.24
60%		0.15	0.11	0.13	0.21	0.17	0.14	0.10	0.11	0.11	0.08	0.09	0.23
70%		0.11	0.11	0.10	0.17	0.16	0.12	0.09	0.10	0.11	0.08	0.08	0.22
80%		0.10	0.10	0.09	0.15	0.13	0.10	0.07	0.08	0.10	0.07	0.07	0.19
90%		0.10	0.10	0.08	0.13	0.11	0.09	0.05	0.04	0.09	0.07	0.07	0.17
Long Term													
Full Simulation Period ^b		0.23	0.22	0.24	0.30	0.23	0.16	0.13	0.12	0.12	0.10	0.15	0.24
Water Year Types^c													
Wet (32%)		0.19	0.17	0.17	0.18	0.14	0.10	0.07	0.07	0.09	0.09	0.08	0.20
Above Normal (16%)		0.28	0.27	0.26	0.29	0.21	0.14	0.11	0.11	0.11	0.08	0.08	0.18
Below Normal (13%)		0.20	0.18	0.20	0.30	0.24	0.16	0.14	0.13	0.12	0.08	0.14	0.25
Dry (24%)		0.23	0.23	0.26	0.37	0.27	0.19	0.16	0.15	0.13	0.11	0.23	0.26
Critical (15%)		0.30	0.32	0.38	0.44	0.37	0.28	0.21	0.18	0.16	0.18	0.26	0.31

Alternative 5 minus Second Basis of Comparison		Monthly Bromide Concentration (mg/L)											
Statistic		Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
Probability of Exceedance^a													
10%		-0.01	0.00	0.04	0.03	0.01	-0.07	0.03	0.03	0.02	0.01	0.03	-0.01
20%		0.00	0.02	0.01	0.01	0.00	0.01	0.04	0.03	0.02	0.01	0.03	0.00
30%		-0.01	-0.02	-0.02	-0.02	0.03	0.02	0.04	0.02	0.02	0.00	0.03	0.01
40%		-0.01	-0.02	-0.05	-0.04	0.03	0.02	0.02	0.02	0.01	0.00	0.00	0.01
50%		-0.02	-0.04	-0.12	-0.06	0.03	0.02	0.01	0.01	0.01	0.00	0.00	0.00
60%		-0.14	-0.17	-0.19	0.02	0.03	0.02	-0.01	0.01	0.02	0.00	0.00	0.01
70%		-0.17	-0.15	-0.19	0.03	0.03	0.01	-0.01	0.01	0.02	0.01	0.00	0.00
80%		-0.16	-0.14	-0.10	0.02	0.02	0.00	-0.01	0.00	0.01	0.00	0.00	-0.01
90%		-0.13	-0.12	-0.01	0.02	0.01	0.00	-0.01	-0.02	0.01	0.00	0.00	-0.01
Long Term													
Full Simulation Period ^b		-0.07	-0.06	-0.06	0.00	0.02	0.01	0.01	0.01	0.01	0.00	0.01	0.00
Water Year Types^c													
Wet (32%)		-0.07	-0.08	-0.07	0.01	0.02	0.00	-0.01	0.00	0.01	0.00	0.00	0.02
Above Normal (16%)		-0.05	-0.03	-0.03	-0.01	0.04	0.02	0.00	0.01	0.01	0.00	0.00	-0.05
Below Normal (13%)		-0.07	-0.07	-0.08	-0.03	-0.04	-0.03	0.01	0.02	0.03	0.01	-0.01	0.02
Dry (24%)		-0.08	-0.07	-0.08	0.00	0.01	0.02	0.03	0.02	0.02	0.01	0.04	0.01
Critical (15%)		-0.05	-0.05	-0.02	0.00	0.04	0.02	0.02	0.03	0.00	-0.01	0.00	-0.01


a Exceedance probability is defined as the probability a given value will be exceeded in any one year.
 b Based on the 82-year simulation period.
 c As defined by the Sacramento Valley 40-30-30 Index Water Year Hydrologic Classification (SWRCB D-1641, 1999); projected to Year 2030.
 Notes: 1) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 2) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternative 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 3) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text.

1 **Appendix 6E Errata**

2 Please add the following pages after page 6E-396 of the Appendix 6E file.

1 **B.28. Sacramento River at Emmaton Compliance with D-1641**
2 **Agricultural Salinity Standard**


Figure 6E.B.28. Sacramento River at Emmatton Compliance with D-1641 Agricultural Salinity Standard

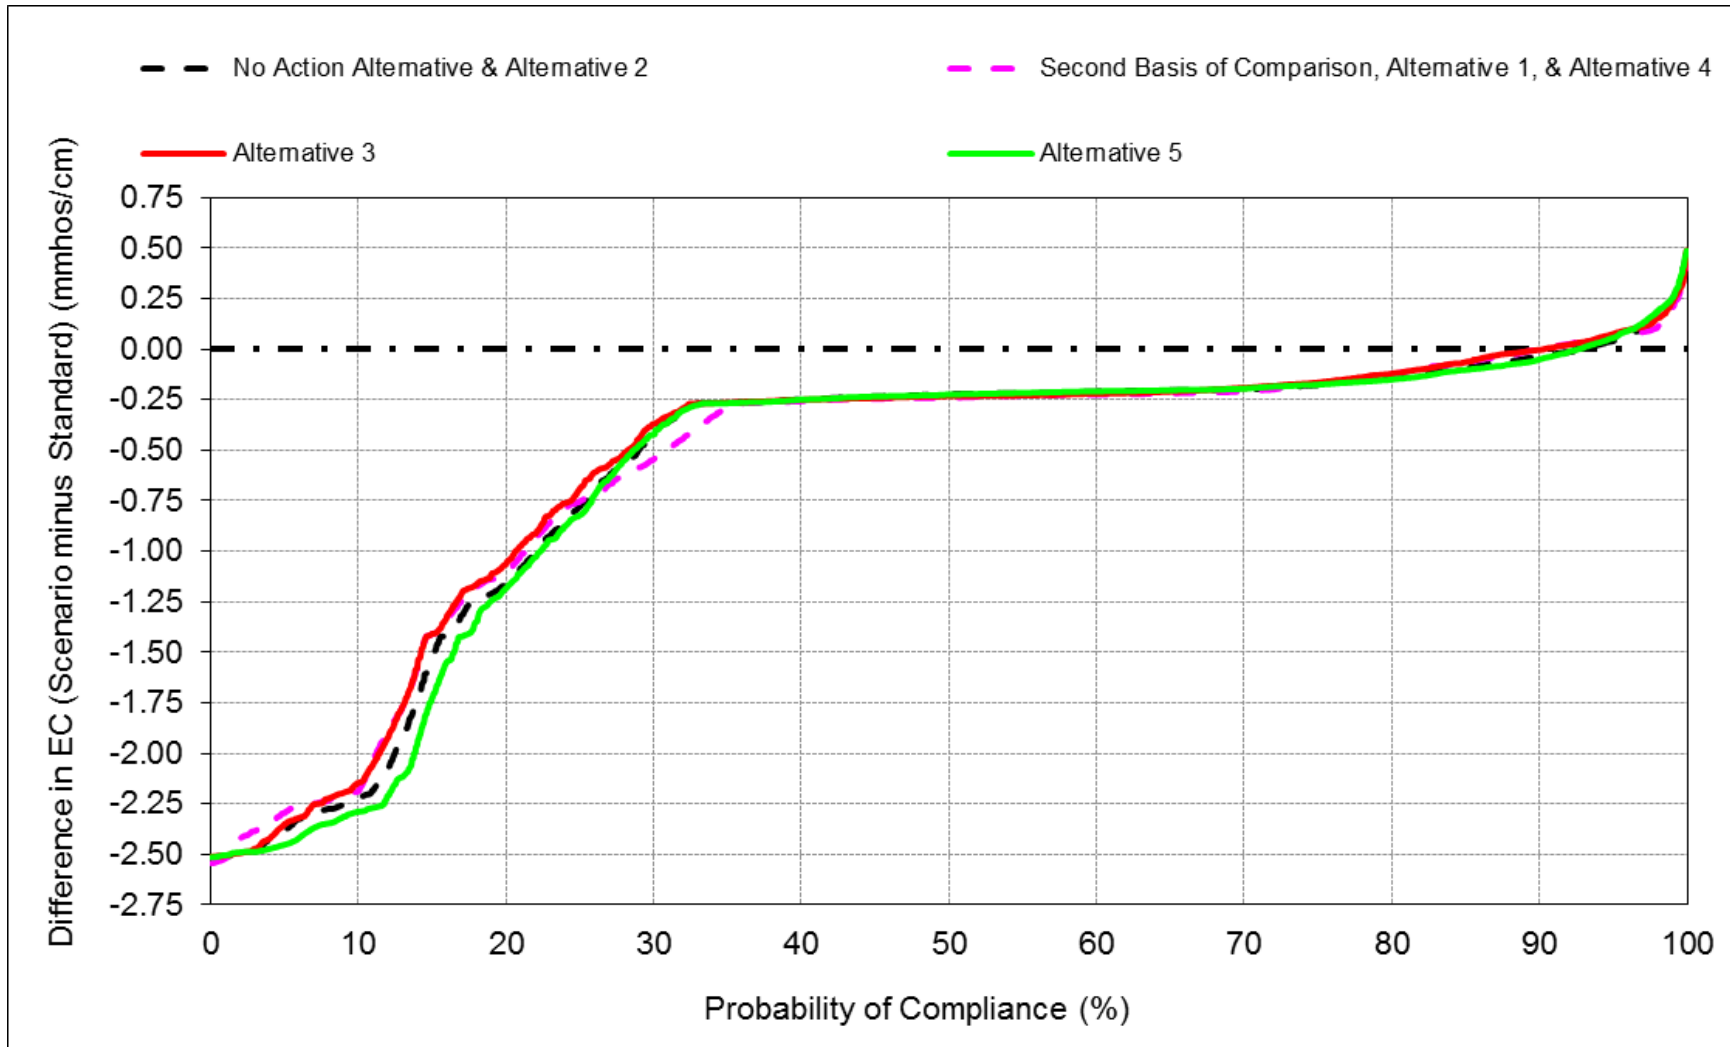

1 **B.29. San Joaquin River at Jersey Point Compliance with D-1641**
2 **Agricultural Salinity Standard**

3


Figure 6E.B.29. San Joaquin River at Jersey Point Compliance with D-1641 Agricultural Water Quality Standard

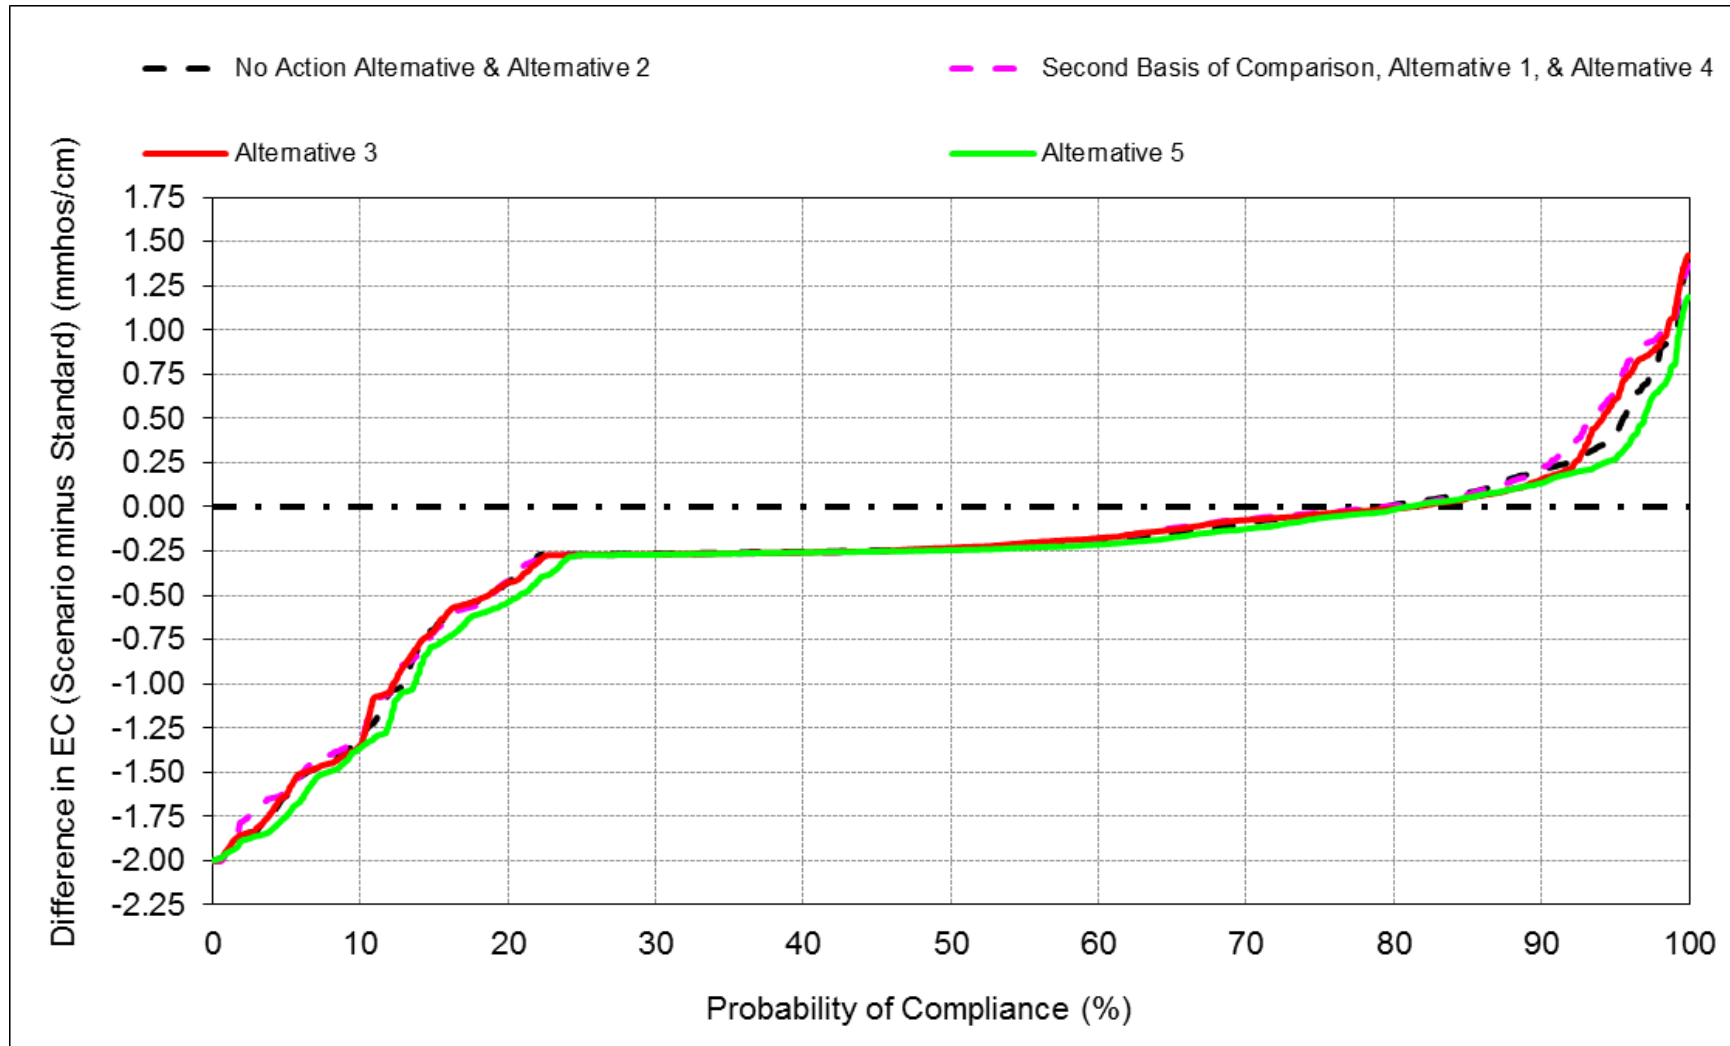

Notes: 1) Probability of compliance is defined as the probability the standard threshold will not be exceeded. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 5) Values are the 14-day average from April through August.


1 **B.30. Contra Costa Canal at Pumping Plant #1 Compliance with**
2 **D-1641 M&I Chloride Standard**

Figure 6E.B.30.1. Contra Costa Canal at Pumping Plant #1 Compliance with D-1641 M&I Chloride Standard

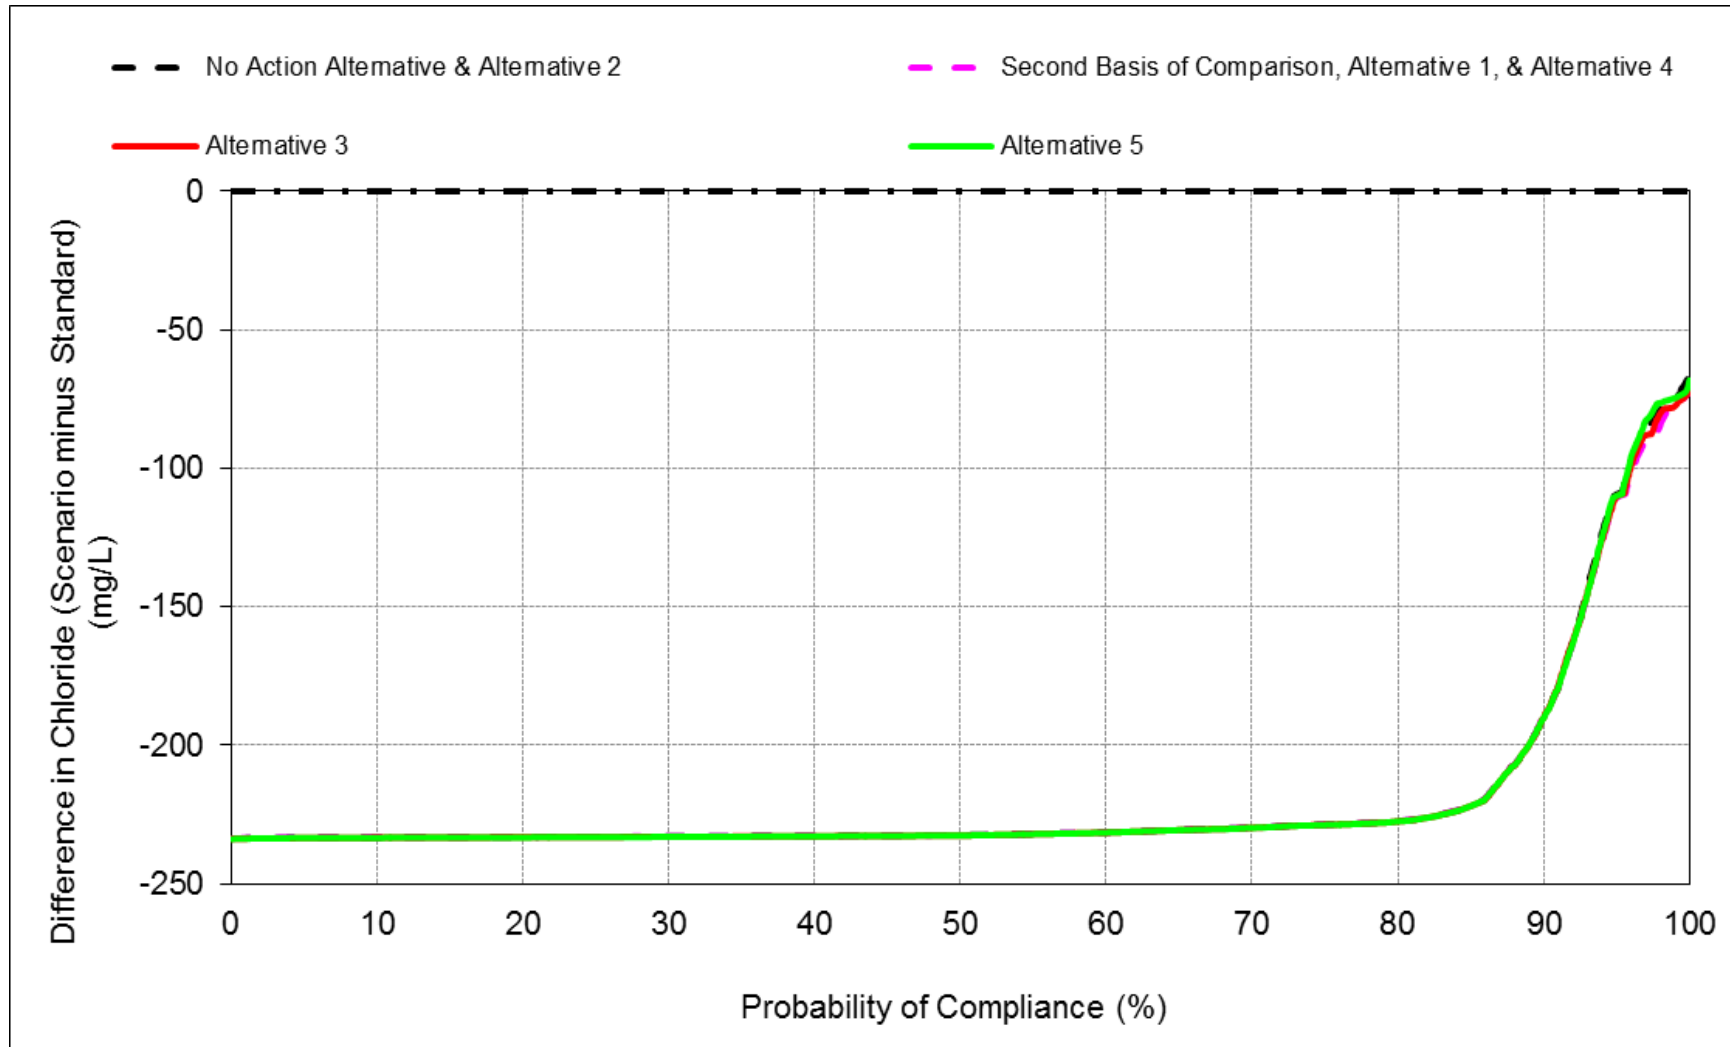


Notes: 1) Probability of compliance is defined as the probability the standard threshold will not be exceeded. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 5) Values are daily average.

Figure 6E.B.30.2. Contra Costa Canal at Pumping Plant #1 Compliance with D-1641 M&I Water Quality Standard

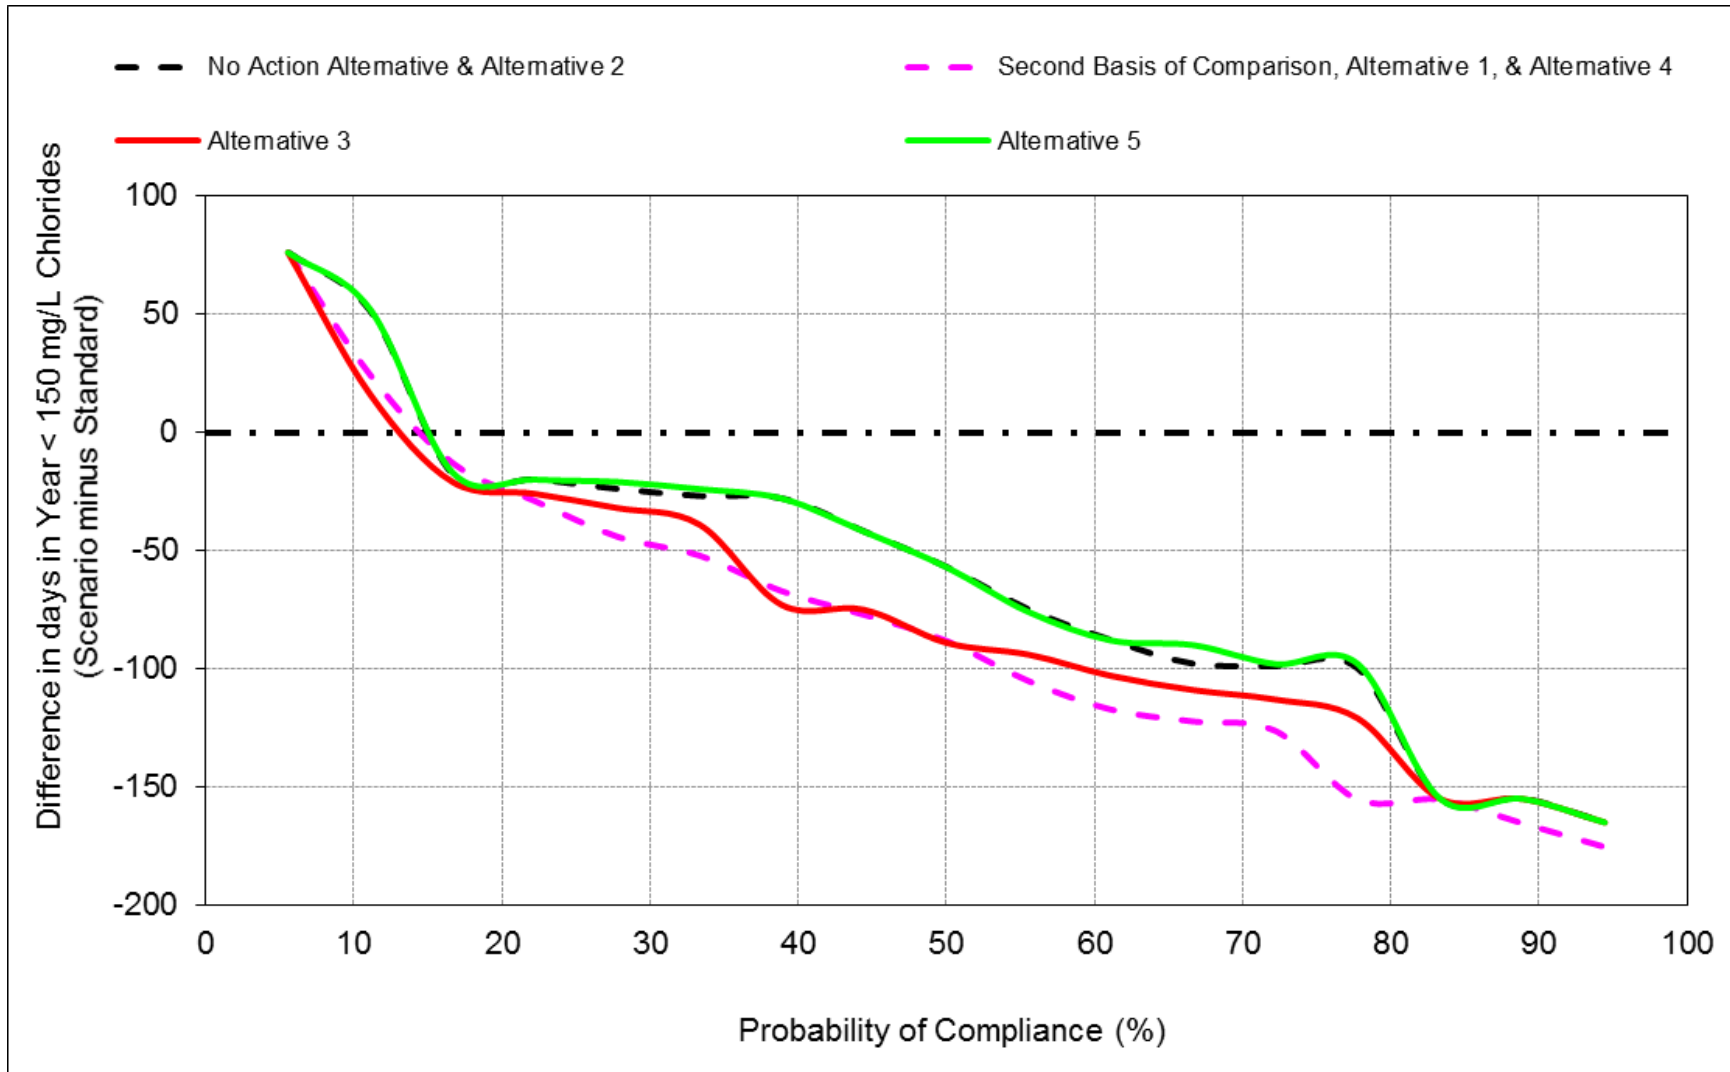

1 **B.31. San Joaquin River at Antioch Water Works Compliance with**
2 **D-1641 M&I Chloride Standard**
3

Figure 6E.B.31. San Joaquin River at Antioch Water Works Compliance with D-1641 M&I Water Quality Standard

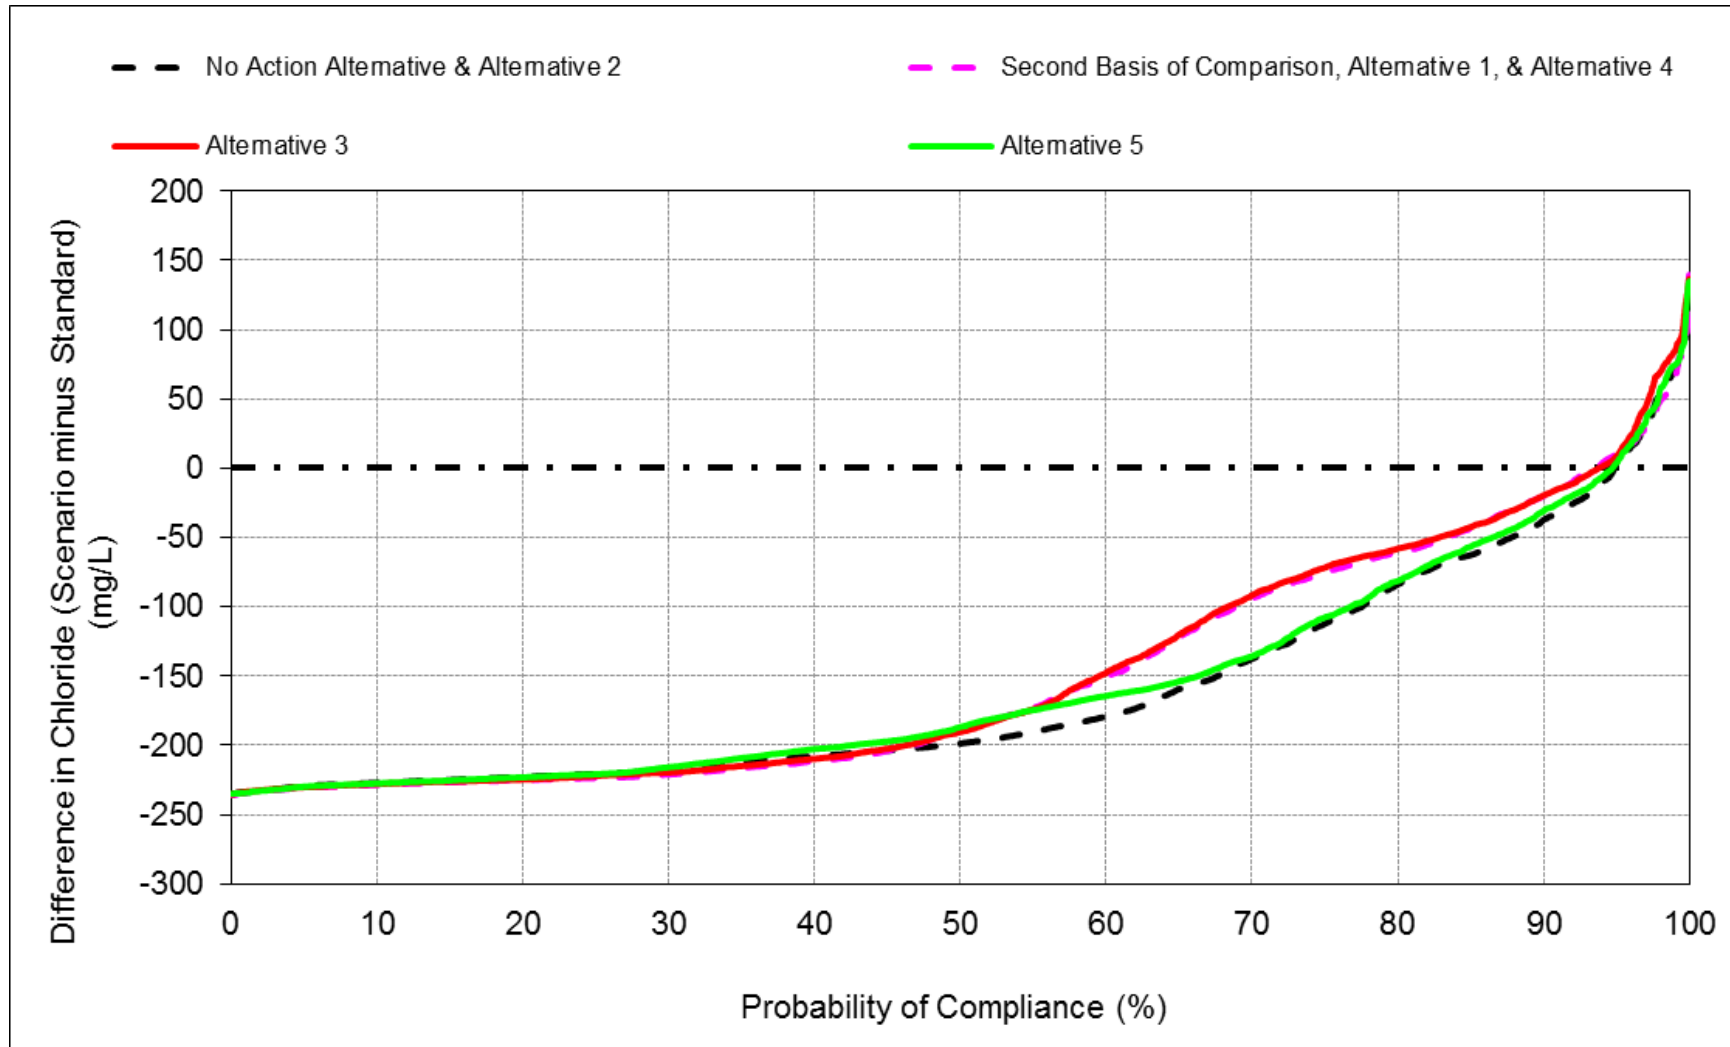


Notes: 1) Probability of compliance is defined as the probability the standard threshold will not be exceeded. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 5) Values are daily average.

1 **B.32. West Canal at Mouth of Clifton Court Forebay Compliance**
2 **with D-1641 M&I Chloride Standard**

3

Figure 6E.B.32. West Canal at mouth of Clifton Court Forebay Compliance with D-1641 M&I Water Quality Standard

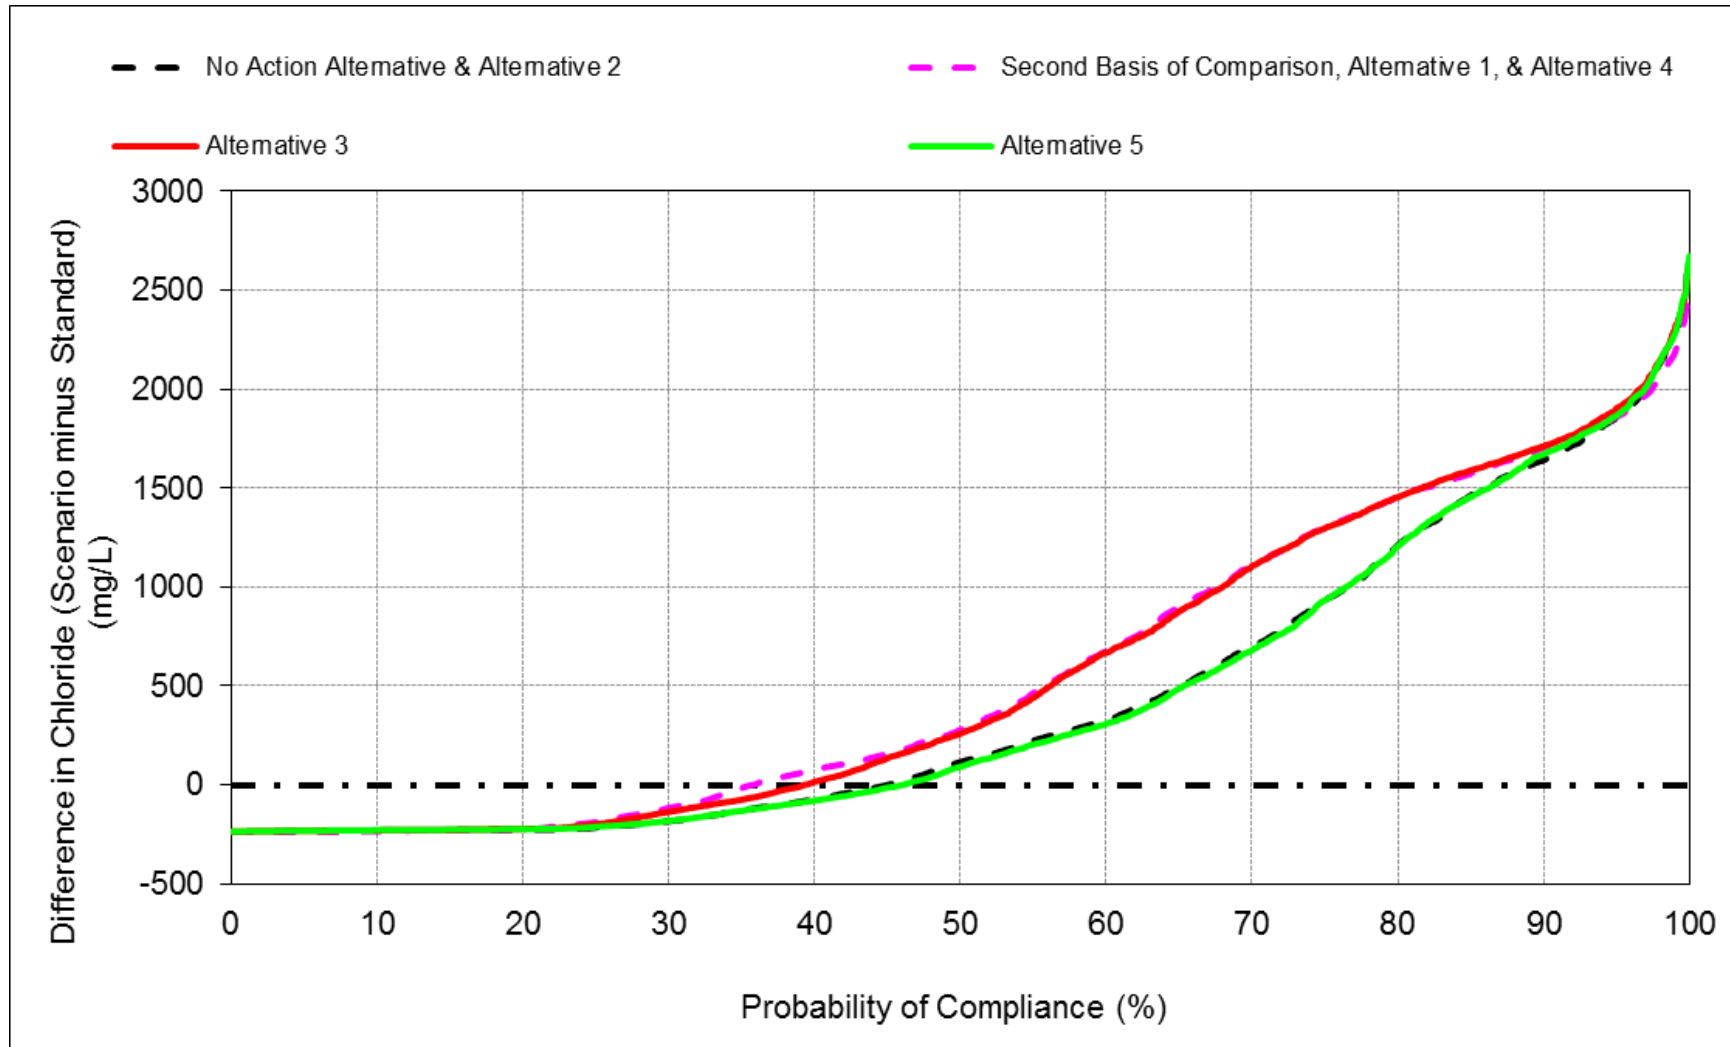


Notes: 1) Probability of compliance is defined as the probability the standard threshold will not be exceeded. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 5) Values are daily average.

1 **B.33. Delta-Mendota Canal at Tracy Pumping Plant Compliance**
2 **Compliance with D-1641 M&I Chloride Standard**

3

Figure 6E.B.33. Delta-Mendota Canal at Tracy Pumping Plant Compliance with D-1641 M&I Water Quality Standard

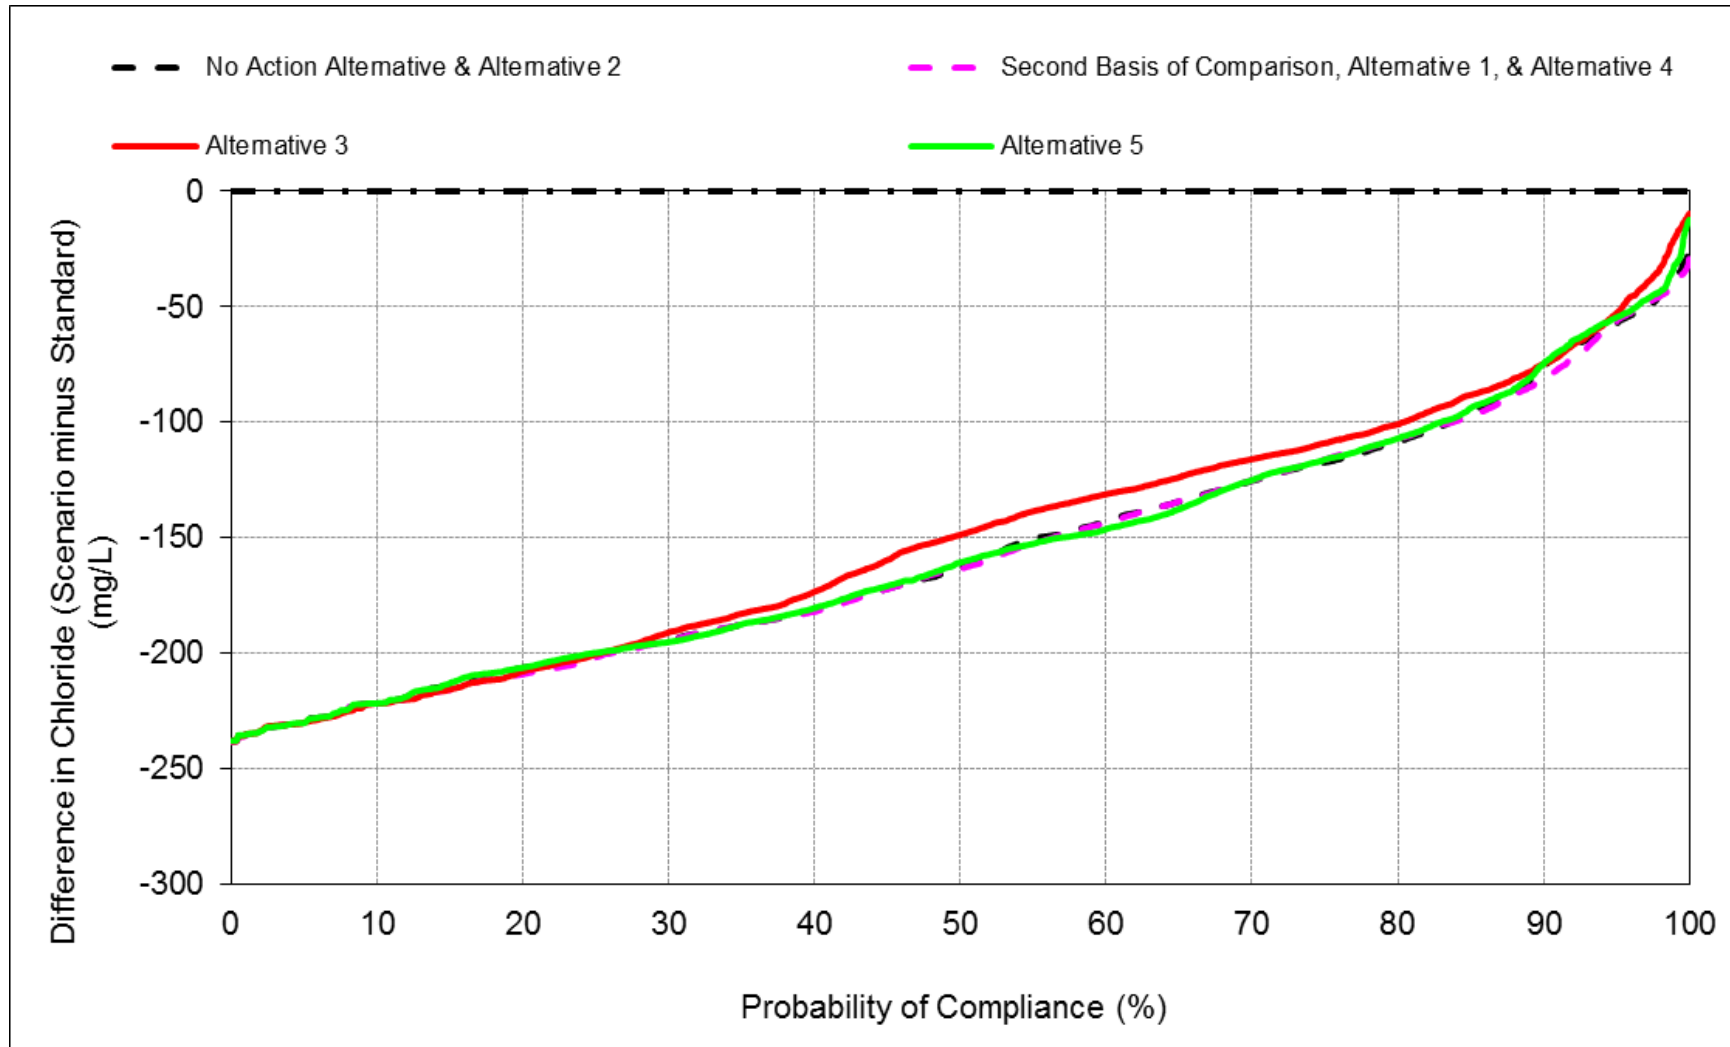


Notes: 1) Probability of compliance is defined as the probability the standard threshold will not be exceeded. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 5) Values are daily average.

1 **B.34. Barker Slough at North Bay Aqueduct Compliance**
2 **Compliance with D-1641 M&I Chloride Standard**

3


Figure 6E.B.34. Barker Slough at North Bay Aqueduct Compliance with D-1641 M&I Water Quality Standard

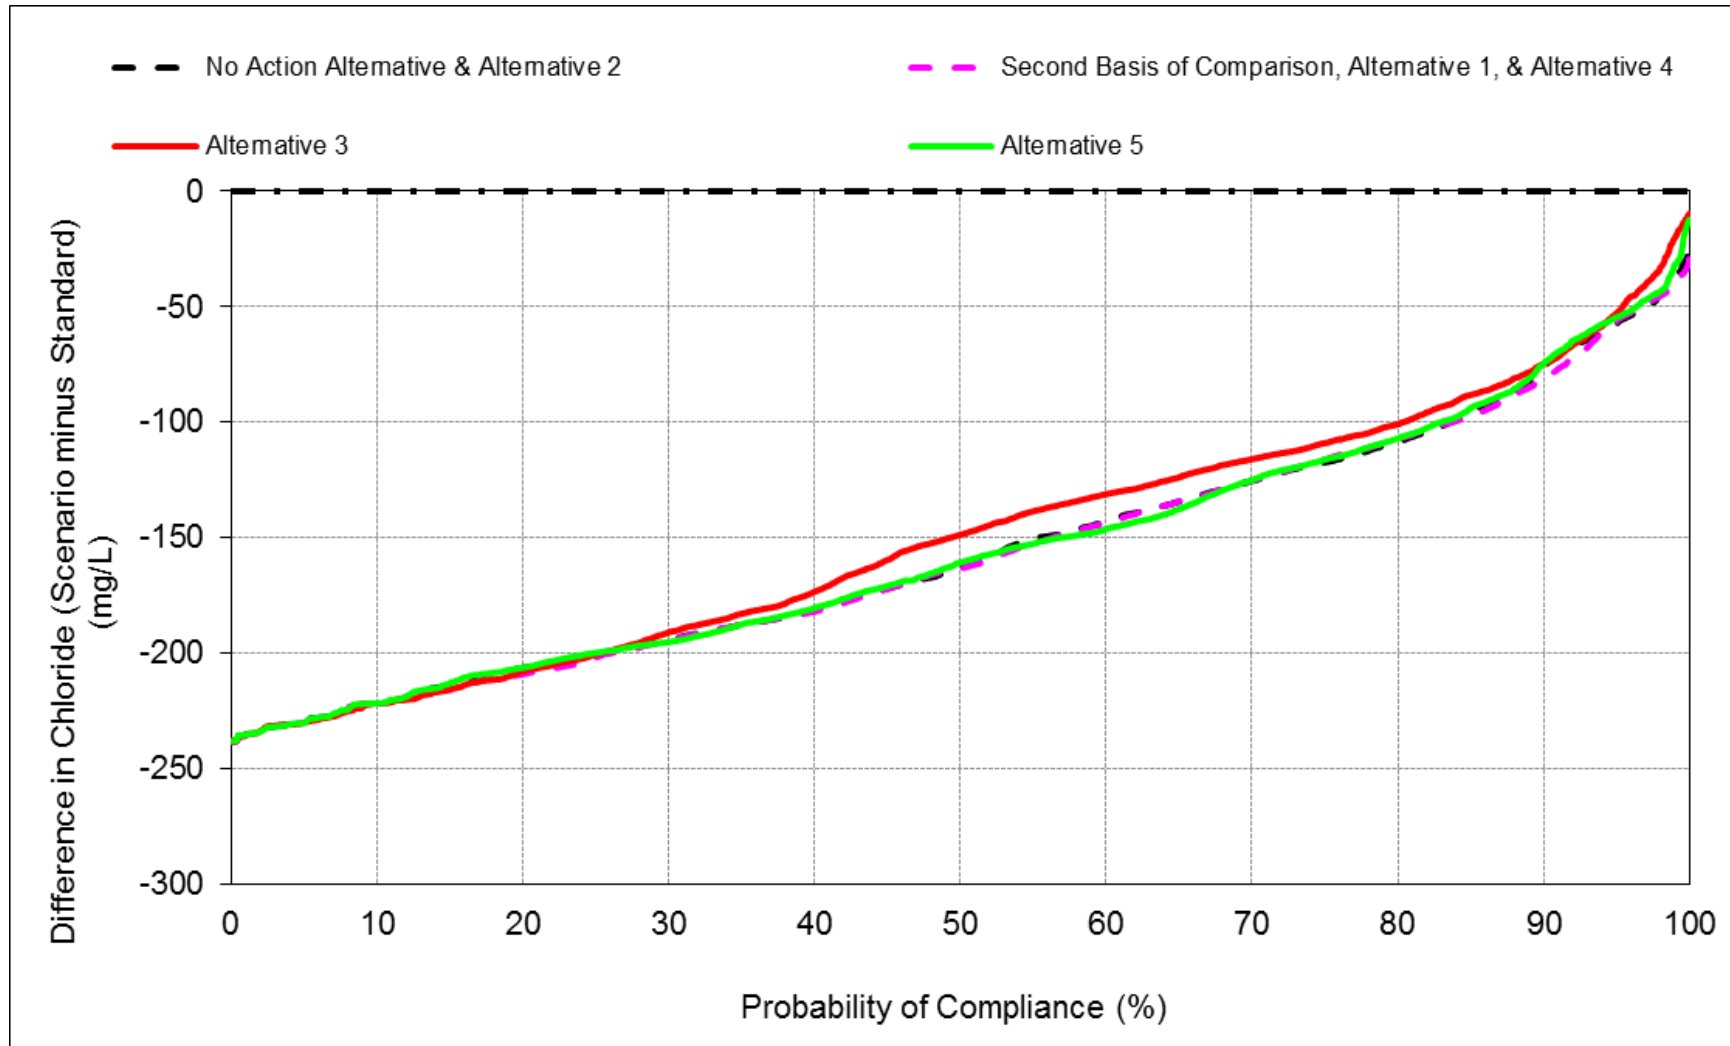

Notes: 1) Probability of compliance is defined as the probability the standard threshold will not be exceeded. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 5) Values are daily average.

1 **B.35. Cache Slough at City of Vallejo Intake Compliance with D-**
2 **1641 M&I Chloride Standard**

Figure 6E.B.35. Cache Slough at City of Vallejo Intake Compliance with D-1641 M&I Water Quality Standard

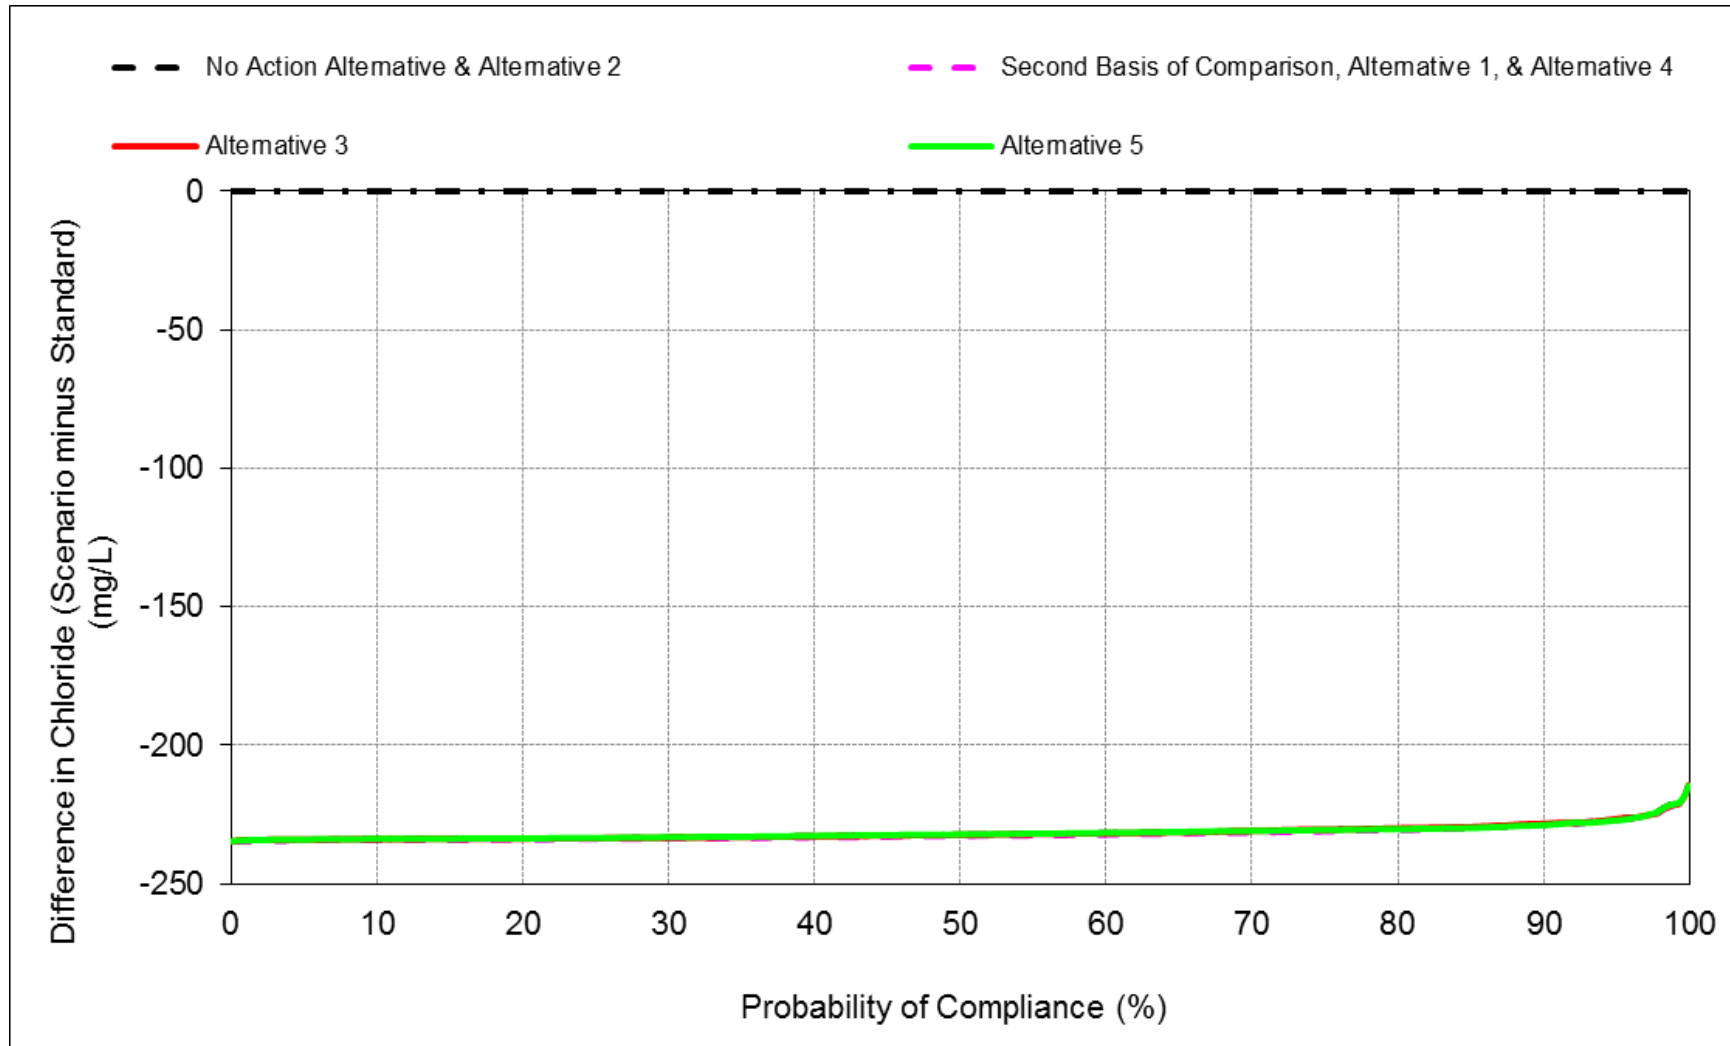

Notes: 1) Probability of compliance is defined as the probability the standard threshold will not be exceeded. 2) All alternatives are simulated with projected hydrology and sea level at Year 2030 conditions. 3) Model results for Alternatives 1, 4, and Second Basis of Comparison are the same, therefore Alternatives 1 and 4 results are not presented. Qualitative differences, if applicable, are discussed in the text. 4) Model results for Alternative 2 and No Action Alternative are the same, therefore Alternative 2 results are not presented. Qualitative differences, if applicable, are discussed in the text. 5) Values are daily average.